

CONSTRUCTION NOTES (Unless otherwise noted) ALL CONSTRUCTION TO ADHERE TO THESE PLANS AND SPEC'S AND TO CONFORM TO THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE CODES AND AUTHORITIES HAVING JURISDICTION, THESE REQUIREMENTS ARE TO BE TAKEN AS MINIMUM SPECIFICATIONS. ONT. REG. 332/12-2012 OBC ROOF CONSTRUCTION NO.210 (10.25kg/m2) ASPHALT SHINGLES, 10mm (3/8") PLYWOOD SHEATHING WITH "H" CLIPS. APPROVED WOOD TRUSSES @ 600mm (24") O.C. MAX. APPROVED EAVES PROTECTION TO EXTEND 900mm (3'-0") FROM EDGE OF ROOF AND MIN. 300mm (12") BEYOND INNER FACE OF EXTERIOR WALL, (EAVES PROTECTION NOT REQ'D FOR ROOF SLOPES 8:12 OR GREATER) 38x89 (2"x4") TRUSS BRACING @ 1830mm (6-0") O.C. AT BOTTOM CHORD. PREFIN. ALUM, EAVESTROUGH, FASCIA, RWL & VENTED SOFFIT, PROVIDE ICE & WATER SHIELD TO ALL ROOF/WALL SURFACES SUSCEPTIBLE TO ICE DAMMING. ROOF SHEATHING TO BE FASTENED 150 (6") -C/c ALONG EDGES & INTERMEDIATE SUPPORTS WHEN TRUSSES SPACED GREATER THAN 406 (16"). ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH MIN. 25% AT EAVES & MIN. 25% AT RIDGE (OBC 9.19.1.2.). FRAME WALL CONSTRUCTION (2"x6") (SB-12-TABLE 2.1.1.2A) SIDING AS PER ELEV.. 19x38 (1'x2") VERTICAL WOOD FURRING. CONTIN. SHEATHING MEMBRANE, 9.5mm (3)6"1 SUZ. TYPE SHEATHING, 38x140 (2'x6") STUDS @ 400mm (16") O.C., INSULATION AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm (1/2") INT. DRYWALL FINISH. SIDING TO BE MIN. 200mm (8") ABOVE FINISI GRADE. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION. FRAME WALL CONSTRUCTION (2"x6") (R28)
SIDING AS PER ELEV., 19x38 (1"x2") VERTICAL WOOD FURRING,
CONTIN. SHEATHING MEMBRANE, 28mm (1½") EXTERIOR STRUCTURAL
INSULATED SHEATHING RSI 0.7 (R4) BY "BP" OR EQUAL, 38x140 (2"x6") STUDS @ 400mm (16") O.C., RSI 4.23 (R24) INSUL. AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm (1/2") INT. SIDING TO BE MIN. 200mm (8") ABOVE FINISH GRADE.

FRAME WALL CONSTRUCTION (2"x4")— GARAGE WALLS
SIDING AS PER ELEV., 19x38 (1"x2") VERTICAL WOOD FURRING,
CONTIN. SHEATHING MEMBRANE, 9.5mm (3/8") EXT. TYPE SHEATHING, 38x89 (2"x4") STUDS @ 400mm (16") O.C. (MAX. HEIGHT 3000mm (9"-10"), WITH APPR. DIAGONAL WALL BRACING. SIDING TO BE MIN. 200mm (8") ABOVE FINISH GRADE.

(2C) RESERVED STUCCO WALL CONSTRUCTION (2"x4") -GARAGE WALLS
STUCCO CLADDING SYSTEM CONFORMING TO O.B.C. 9.27.1.1.(2) & (2D) 9.28 THAT EMPLOY A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 25mm (1") MIN. EXPANDED OR EXTRUDED RIGID POLYSTYRENE ON APPROVED

WALLS ADJACENT TO ATTIC SPACE — NO CLADDING 9.5mm (3/8") EXT. TYPE SHEATHING, 38x140 (2"x6") STUDS @ 400mm (16") O.C., INSULATION AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm (1/2") INTERIOR DRYWALL FINISH. MID-HEIGHT BLOCKING REQ'D. IF NO SHEATHING APPLIED. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL

AIR/MOISTURE BARRIER ON 13mm (1/2") EXT. TYPE SHEATHING ON

38x89 (2"x4") STUDS @ 400 (16") O.C., STUCCO TO BE MIN. 200 (8")

BRICK VENEER CONSTRUCTION (2"x6") (SB-12-TABLE 2.1.1.2.A)
90mm (4") FACE BRICK, 25mm (1") AIR SPACE, 22x180x0.76mm
(7/8"x7"x0.03") GALV. METAL TIES @ 400mm (16") O.C. HORIZONTAL 600mm (24") O.C. VERTICAL, APPROVED SHEATHING PAPER, 9.5mm (3/8") EXT. TYPE SHEATHING, 38x 140 (2'x6") STUDS @ 400mm (16")
O.C., INSULATION & APPR. VAPOUR BARRIER WITH APPR. CONTIN.
AIR BARRIER. 13mm (1/2") INTERIOR DRYWALL FINISH. PROVIDE WEEP HOLES @ 800mm (32") O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION. BRICK TO BE MIN. 150mm (6") ABOVE FINISH GRADE

BRICK VENEER CONSTRUCTION (2"x6") (R28)
90mm (4") FACE BRICK, 25mm (1") AIR SPACE, 22x180x0.76mm
(7/8"x7"x0.03") GALV. METAL TIES @ 400mm (16") O.C. HORIZONTAL
600mm (24") O.C. VERTICAL. APPR. SHEATHING PAPER, 28mm (1½")
EXT. STRUCT. INSULATED SHEATHING RSI 0.7 (R4) BY "BP" OR EQUAL, 38x140 (2"x6") STUDS @ 400mm [16") O.C., RSI 4.23 (R24) INSUL. & APPR. VAPOUR BARRIER WITH APPR. CONTIN. AIR BARRIER. 13mm [1/2"] INT. DEYWALL INISH, PROVIDE WEEP HOLES @ 800mm [32") O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER. BRICK TO BE MIN. 150mm (6") ABOVE FINISH GRADE.

BRICK VENEER CONSTRUCTION (2"x4")— GARAGE WALLS 90mm (4") FACE BRICK, 25mm (1") AIR SPACE, 22x180x0.76mm (7/8"x7"x0.03") GALV. METAL TIES @ 400mm (16") O.C. HORIZONTAL 600mm (24") O.C. VERTICAL. APPR. SHEATHING PAPER, 9.5mm (3/8") EXT. TYPE SHEATHING, 38x89 (2"x4") STUDS @ 400mm [16"] O.C. (MAX. HEIGHT 3000mm 9"-10") WITH APPR. DIAGONAL WALL BRACING. PROVIDE WEEP HOLES @ 800mm (32") O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER.

BRICK TO BE MIN. 150mm (6") ABOVE FINISH GRADE. STUCCO WALL CONSTRUCTION (2"x6")
STUCCO CLADDING SYSTEM CONFORMING TO O.B.C. 9.27.1.1.(2) &
9.28 THAT EMPLOYS A MINIMUM 10mm AIR SPACE BEHIND THE
CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED
PER MANUFACTURERS SPECIFICATIONS OVER 25mm (1") MIN. EXTRUDED OR EXPANDED RIGID POLYSTYRENE ON APPR. CONTIN. AIR/MOISTURE BARRIER ON 13mm (1/2") EXT. TYPE SHEATHING ON 38x140 (2"x6") STUDS @ 400mm (16") C.C., INSULATION, APPROVED VAPOUR BARRIER, 13mm (1/2") GYPSUM WALLBOARD INTERIOR FINISH. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED

STUCCO TO BE MIN. 200 (8") ABOVE FINISH GRADE. INTERIOR STUD PARTITIONS
FOR BEARING PARTITIONS 38x89 (2"x4") @ 400mm (16") O.C. FOR 2 STOREYS AND 300mm (12") O.C. FOR 3 STOREYS, NON-BEARING PARTITIONS 38x89 (2"x4") @ 600mm (24") O.C. PROVIDE 38x89 (2"x4") BOTTOM PLATE AND 2/38x89 (2/2"x4") TOP PLATE. 13mm (1/2") INT. DRYWALL BOTH SIDES OF STUDS, PROVIDE 38x140 (2"x6") STUDS/PLATES WHERE NOTED.

MINIMUM THERMAL INSULATION

FOUNDATION WALL/FOOTINGS: (9.15.3, 9.15.4, 9.13.2, 200mm (8") POURED CONC. FDTN. WALL 15MPa (2200psi) BITUMENOUS DAMPPROOFING AND DRAINAGE LAYER, DRAINAGE LAYER REQ'D. WHEN BASEMENT INSUL. EXTENDS 900 [2-11"] BELOW FIN. GRADE, DRAINAGE LAYER IS NOT REQ'D. WHEN FDTN. WALL IS WATERPROOFED. MAXIMUM POUR HEIGHT 2390 (7'-10") ON 500x155 (20"x6") CONTINUOUS KEYED CONC. FTG. BRACE FOTN. WALL PRIOR TO BACKFILLING, ALL FOOTINGS SHALL REST ON NATURAL UNDISTURBED SOIL OR COMPACTED ENGINEERED FILL, WITH MIN. BEARING CAPACITY OF 150kPa OR GREATER. IF SOIL BEARING DOES NOT MEET MINIMUM CAPACITY, ENGINEERED FOOTINGS ARE

STOREYS SUPPORTED W/ MASONRY VENEER W/ SIDING ONLY 20" WIDE x 6" DEEP 20" WIDE x 6" DEEP 26" WIDE x 9" DEEP 26" WIDE x 9" DEEP

-SEE OBC 9.15.3 -AAZIMUM FLOOR LIVE LOAD OF 2.4kPa. (50psf.) PER FLOOR, AND MAX. LENGTH OF SUPPORTED FLOOR JOISTS IS 4.9m (16'-1"). -REFER TO SOILS REPORT FOR SOIL CONDITIONS AND BEARING

STRIP FOOTING SUPPORTING EXTERIOR WALLS (FOR W.O.B.)
-ASSUMING MASONRY VENEER CONSTRUCTION, MAX, FLOOR LIVE
LOAD OF 2.4kPa. (50psf.) PER FLOOR, AND MAX. LENGTH OF SUPPORTED FLOOR JOISTS IS 4.9m (16'-1"). THE STRIP FOOTING SIZE IS AS FOLLOWS:

2 STOREY WITH WALK-OUT BASEMENT 545x175 (22"x7") FOUNDATION DRAINAGE DBC. 9.14.2. & 9.14.3.

100mm (4") DIA. FOUNDATION DRAINAGE TILE 150mm (6") CRUSHED STONE OVER AND AROUND DRAINAGE TILES.

BASEMENT SLAB OBC. 9.3.1.6.(1)(b). 9.16.4.5.(1). 9.25.3.3.(15) 80mm (3")MIN. 25MPa (3600psi) CONC. SLAB ON 100mm (4") COARSE GRANULAR FILL, OR 20MPa. (3000psi) CONC. WITH DAMPPROOFING BELOW SLAB. UNDER SLAB INSULATION PER SB-12. ALL SLAB JOINTS & PENETRATIONS TO BE CAULKED.

EXPOSED FLOOR TO EXTERIOR (SB-12-TABLE 2.1.1.2.A)
PROVIDE RSI 5.46 (R31) INSULATION, APPROVED VAPOUR BAR AND CONTINUOUS AIR BARRIER, FINISHED SOFFIT.

ATTIC INSULATION (SB-12-TABLE 2.1.1.2A) (SB-12-2.1.1.7)
RSI 8.81 (R50) BLOWN IN ROOF INSULATION AND APPROVED VAPOUR
BARRIER, 16mm (5/8") INT. DRYWALL FINISH OR APPROVED EQUAL. RSI 3.52 (R20) MIN. ABOVE INNER SURFACE OF EXTERIOR WALL

(10) ALL STAIRS/EXTERIOR STAIRS -OBC. 9.8.-UNIFORM RISE -5mm (1/4") MAX BETWEEN ADJACENT TREADS OR LANDINGS
-10mm (1/2") MAX BETWEEN TALLEST & SHORTEST RISE IN FLIGHT

= 200 (7-7/8") = 210 (8-1/4") = 235 (9-1/4") = 25 (1") = 1950 (6'-5") MIN. RUN MIN. TREAD MAX. NOSING MIN. HEADROOM RAIL @ LANDING = 900 (2'-11") RAIL @ STAIR = 865 (2'-10") to 965 (3'-2") MIN. STAIR WIDTH = 860 (2'-10")

FOR CURVED STAIRS = 150 (6") MIN AVG PUN = 200 (8")

MAX. RISE

HANDRAILS -OBC. 9.8.7.-FINISHED RAILING ON PICKETS SPACED MAXIMUM 100mm (4") BETWEEN PICKETS. CLEARANCE BETWEEN HANDRAIL AND SURFACE BEHIND IT 10 BE 50 (2") MIN. HANDRAILS TO BE CONTINUOUS EXCEPT FOR NEWEL POST AT CHANGES OF DIRECTION.

INTERIOR GUARDS -OBC. 9.8.8.-

INTERIOR GUARDS: 900mm (2-11") MIN. HIGH
EXTERIOR GUARDS — OBC. 9.8.8.
900mm (36") HIGH GUARD WHERE DISTANCE FROM PORCH TO FIN.
GRADE IS LESS THAN 1800mm (71"). 1070mm (42") HIGH GUARD IS REQUIRED WHERE DISTANCE EXCEEDS 1800mm (71").

SILL PLATE — OBC. 9.23.7.
38x89 (2"x4") SILL PLATE WITH 13mm (1/2") DIA. ANCHOR BOLTS (12.) 200mm (8") LONG, EMBEDDED MIN. 100mm (4") INTO CONC. @ 2400mm (7"-10") O.C., CAULKING OR 25 (1") MIN. MINERAL WOOL BETWEEN PLATE AND TOP OF FDTN. WALL. USE NON-SHRINK GROUT TO LEVEL SILL PLATE WHEN REQUIRED.

BASEMENT INSULATION (SB-12-2.1.1.6), 9.25.2.3, 9.13.2.6) FOUNDATION WALLS ENCLOSING HEATED SPACE SHALL BE INSULATED FROM THE UNDERSIDE OF THE SUBFLOOR TO NOT MORE THAN 200mm (8") ABOVE THE FINISHED FLOOR & NO CLOSER THAN 50mm (2") OF THE BASEMENT SLAB INSULATION TO HAVE APPROVED VAPOUR BARRIER. DAMPPROOF WITH BUILDING PAPER BETWEEN THE FOUNDATION WALL AND INSULATION UP TO GRADE LEVEL. NOTE: FULL HEIGHT INSULATION AT COLD CELLAR WALLS. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION. AIR BARRIER TO BE SEALED TO FOTN, WALL

BEARING STUD PARTITION

38x89 (2"x4") STUDS @ 400mm (16") O.C. 38x89 (2"x4") SILL PLATE ON DAMPPROOFING MATERIAL, 13mm (1/2") DIA. ANCHOR BOLTS

200mm (8") LONG, EMBEDDED MIN, 100mm (4") INTO CONC. @ 2400mm (7'-10") O.C. 100mm (4") HIGH CONC. CURB ON 350x155 (14"x6") CONC. FOOTING. ADD HORIZ, BLOCKING AT MID-HEIGHT IF WALL IS UNFINISHED.

STEEL BASEMENT COLUMN
89mm(3-1/2") DIA x 3.0mm(0.118) SINGLE WALL TUBE TYPE 2
ADJUSTABLE STL. COL. W/ MIN. CAPACITY OF 71.2kN (16,000lbs.) AT
A MAX. EXTENSION OF 2318mm (7-7 1/2") CONFORMING TO
CAN/CGS8-7.2-94, AND WITH 150x150x9.5 (6"x6"x3/8") STL. PLATE TOP & BOTTOM, 870x870x410 (34\*x34\*x16\*) CONC. FOOTING ON UNDISTURBED SOIL OR ENGINEERED FILL CAPABLE OF SUSTAINING PRESSURE OF 150 Kpg. MINIMUM AND AS PER SOILS REPORT.

STEEL BASEMENT COLUMN (SEE O.B.C. 9.15.3.3)
89mm(3-1/2") DIA x 4.78mm(.188) FIXED STL. COL. WITH 150x150x9.5
(6"x6"x3/8") STL. TOP & BOTTOM PLATE ON 1070x1070x460 (42"x42"x18"). CONC. FOOTING ON UNDISTURBED SOIL OR ENGINEERED FILL CAPABLE OF SUSTAINING A PRESSURE OF 150 Kpg MIN. AND AS PER SOILS REPORT.

STEEL COLUMN 90mm(3-1/2") DIA x 4.78mm(.188) NON-ADJUSTABLE STL. COL. TO BE ON 150x150x9.5 (6"x6"x3/8") STEEL TOP PLATE, & BOTTOM PLATE. BASE PLATE 120x250x12.5 (4 1/2"x10"x1/2") WITH 2-12mm DIA. x 300mm LONG x50mm HOOK ANCHORS (2-1/2"x12"x2") FIELD WELD COL. TO BASE PLATE.

16) BEAM POCKET OR 300x150 (12"x6") POURED CONC. NIB WALLS. MIN. BEARING 90mm (3-1/2")

19x64 (1"x3") CONTINUOUS WOOD STRAPPING BOTH SIDES OF STEEL

GARAGE SLAB 100mm (4") 32MPa (4640psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT ON OPT. 100 [4") COARSE GRANULAR FILL WITH COMPACTED SUB-BASE OR COMPACTED NATIVE FILL. SLOPE TO FRONT.

GARAGE CEILINGS/INTERIOR WALLS 13mm (1/2") GYPSUM BOARD ON WALL AND CEILING BETWEEN HOUSE AND GARAGE. TAPE AND SEAL ALL JOINTS AIRTIGHT PER O.B.C. 9.10.9.16. REFER TO SB-12, TABLE 2.1.1.2.A. FOR REQUIRED THERMAL INSULATION.

DOOR AND FRAME GASPROOFED. DOOR EQUIPPED WITH SELF CLOSING DEVICE AND WEATHERSTRIPPING PER OBC 9.10.13.15.

EXTERIOR STEP
PRECAST CONCRETE STEP OR WOOD STEP WHERE NOT EXPOSED
TO WEATHER. MAX. RISE 200mm (7-7/8") MIN. TREAD 250mm
(9-1/2"). SEE OBC. 9.8.9.2., 9.8.9.3. & 9.8.10.

DRYER EXHAUST (OBC-6.2.3.8.(7) & 6.2.4.11.)
CAPPED DRYER EXHAUST VENTED TO EXTERIOR.
(USE 100mm (4") DIA. SMOOTH WALL VENT PIPE)

INSULATED ATTIC ACCESS (OBC-9.19.2.1, & SB12-2.1.1.7)
ATTIC ACCESS HATCH WITH MIN. DIMENSION OF 545x610mm (21
1/2"x24") & A MIN. AREA OF 0.32 SQ.M. (3.44 SQ.FT.) WITH WEATHERSTRIPPING. RSI 3.52 (R20) RIGID INSUL. BACKING

FIREPLACE CHIMNEYS OBC. 9.21.

TOP OF FIREPLACE CHIMNEY SHALL BE 915mm (3'-0") ABOVE THE HIGHEST POINT AT WHICH IT COMES IN CONTACT WITH THE ROOF AND 610mm (2'-0") ABOVE THE ROOF SURFACE WITHIN A HORIZ DISTANCE OF 3050mm (10'-0") FROM THE CHIMNEY.

(25.) LINEN CLOSET, 4 SHELVES MIN. 350mm (14") DEEP.

MECHANICAL EXHAUST FAN, VENTED TO EXTERIOR AS REQUIRED BY OBC. 9.32.3.5. & 9.32.3.10.

STEEL BEARING PLATE FOR MASONRY WALLS 280x280x16 (11'x11'x5/8") STL. PLATE FOR STL BEAMS AND 280x280x12 (11'x11'x1/2") STL. PLATE FOR WOOD BEAMS BEARING ON CONC. BLOCK PARTYWALL, ANCHORED WITH 2-19mm (3/4") x 200mm (8") LONG GALV. ANCHORS WITHIN SOLID BLOCK COURSE. LEVEL WITH NON-SHRINK GROUT.

OR SOLID WOOD BEARING FOR WOOD STUD WALLS SOLID BEARING TO BE AT LEAST AS WIDE AS THE SUPPORTED MEMBER. SOLID WOOD BEARING COMPRISED OF BUILT-UP WOOD STUDS TO BE CONSTRUCTED IN ACCORDANCE WITH OBC

RESERVED BEARING WOOD POST (BASEMENT) (OBC 9.17.4.)
3-38x140 (3-2"x6") BUILT-UP-POST ON METAL BASE SHOE ANCHORED TO CONC. WITH 12.7 DIA. BOLT, 610x610x300 (24"x24"x12") CONC.

STEPPED FOOTINGS OBC 9.15.3.9.
MIN. HORIZ. STEP = 600mm (24"). MAX. VERT. STEP = 600mm (24")

SLAB ON GRADE

MIN. 100mm (4") CONCRETE SLAB ON GRADE ON 100mm (4")

COARSE GRANULAR FILL. REINFORCED WITH 6x6-W2.9xW2.9 MESH
PLACED NEAR MID-DEPTH OF SLAB. CONC. STRENGTH 32 MPG
(4440 psi) WITH 5-8% AIR ENTRAINMENT ON COMPACTED

(4440 psi) WITH 5-8% AIR ENTRAINMENT ON COMPACTED SUB-GRADE. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED

MINIMUM THERMAL INSULATION UNDER SLAB. DIRECT VENTING GAS FURNACE/ H.W.T VENT DIRECT VENT FURNACE TERMINAL MIN. 900mm (36") FROM A GAS REGUILATOR. MIN. 300mm (12") ABOVE FIN. GRADE, FROM ALL OPENINGS, EXHAUST AND INTAKE VENTS. HRV INTAKE TO BE A MIN. OF 1830mm (6'-0") FROM ALL EXHAUST TERMINALS. REFER TO GAS UTILIZATION CODE

DIRECT VENTING GAS FIREPLACE VENT
DIRECT VENT GAS FIREPLACE. VENT TO BE A MINIMUM 300mm (12")
FROM ANY OPENING AND ABOVE FIN. GRADE. REFER TO GAS UTILIZATION CODE.

SUBFLOOR. JOIST STRAPPING AND BRIDGING
16mm (5/8") T & G SUBFLOOR ON WOOD FLOOR JOISTS. FOR
CERAMIC TILE APPLICATION (\* SEE DOSC 9.30.6. \*) 6mm (1/4") PANEL
TYPE UNDERLAY UNDER RESILIENT & PARQUET FLOORING. (\* SEE OBC 9.30.2.\*) FLOOR JOISTS WITH SPANS OVER 2100mm (6'-11") TO BE BRIDGED WITH 38x38 (2"x2") CROSS BRACING OR SOLID BLOCKING @ 2100mm (6'-11") O.C. MAX. AND WHERE SPECIFIED BY JOIST TABLES A-1 OR A-2 STRAPPING SHALL BE 19x64 (1"x3") @ 2100mm (6'-11")

O.C. UNLESS A PANEL TYPE CEILING FINISH IS APPLIED.

EXPOSED BUILDING FACE OBC. 9.10.15. & SB-2-2.3.5.(2) EXTERIOR WALLS TO HAVE A FIRE RESISTANCE RATING OF NOT LESS THAN 45 min. WHERE LIMITING DISTANCE (LD) IS LESS THAN 1.2M (3'-11"). WHERE THE LD IS LESS THAN 600mm (1'-11") THE EXPOSING FACE SHALL BE CLAD IN NON-COMBUSTIBLE MATERIAL. SEE ELEVATIONS FOR ADDITIONAL NOTES. OFFENDING GARAGE WALLS INCLUDED.

COLD CELLAR PORCH SLAB (OBC 9.39.)
FOR MAX. 2500mm (8'-2") PORCH DEPTH (SHORTEST DIM.), 125mm (5") 32MPC (4640psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT, REINF, WITH 10M BARS @ 200mm (7 7/8") O.C. EACH WAY IN BOTTOM THIRD OF SLAB, MIN. 30mm (1 1/4") COVER, 600x600 (23 5/8"x23 5/8") 10M DOWELS @ 600mm (23 5/8") O.C., ANCHORED IN PERIMETER FDT. WALLS, SLOPE SLAB MIN. 1.0% FROM HOUSE WALL, SLAB TO HAVE MIN. 75mm (3") BEARING ON FDTN. WALLS. PROVIDE (L7) LINTEL OVER CELLAR DOOR WITH 100mm (4") END BEARING.

THE FDTN, WALL SHALL NOT BE REDUCED TO LESS THAN 90mm (3-1/2") THICK TO A MAX. DEPTH OF 600mm (24") AND SHALL BE TIED TO THE FACING MATERIAL WITH METAL TIES SPACED 200mm (8") O.C. YERTICALLY AND 900mm (36") O.C. HORIZONTALLY. FILL SPACE BETWEEN WALL AND FACING SOLID WITH MORTAR CONVENTIONAL ROOF FRAMING (2.0Kpg. SNOW LOAD)

38x140 (2"x6") RAFTERS @ 400mm (16"O.C.) FOR MAX 11'-7" SPAN, 38x184 (2"x8") RIDGE BOARD, 38x89 (2"x4") COLLAR TIES AT MIDSPANS. CEILING JOISTS TO BE 38x89 (2"x4") @ 400mm (16") O.C. FOR MAX. 2830mm (9'-3") SPAN & 38x140 (2"x6") @ 400 (16") O.C. FOR MAX. 4450mm (14'-7") SPAN. RAFTERS FOR BUILT-UP ROOF TO BE 38x89 (2"x4") @ 600mm (24") O.C. WITH A 38x89 (2"x4") CENTRE POST TO THE TRUSS BELOW, LATERALLY BRACED @ 1800mm (6'-0") O.C. VERTICALLY.

WINDOWS:1) MINIMUM BEDROOM WINDOW -OBC. 9.9.10.1.-AT LEAST ONE BEDROOM WINDOW ON A GIVEN FLOOR IS HAVE MIN. 0.35m2 UNOBSTRUCTED GLAZED OR OPENABLE AREA WITH MIN. CLEAR WIDTH OF 380 mm (1"-3").

 WINDOW GUARDS -OBC. 9.8.8.1.(6). A GUARD IS REQUIRED WHERE THE TOP OF THE WINDOW SILL IS LOCATED LESS THAN 480mm (1-7") ABOVE FIN. FLOOR AND THE DISTANCE FROM THE FIN, FLOOR TO THE ADJACENT GRADE IS GREATER THAN 1800mm (5"-11")

3) EXTERIOR WINDOWS
SHALL COMPLY WITH OBC DIV.-B 9.7.3. & SB12-2.1.1.8

9.14.6.3. CHECK WITH THE LOCAL AUTHORITY

| GENERAL: 1) MECHANICAL VENTILATION IS REQUIRED TO COMPLY WITH OBSC-DIV. 8. 6.2.2. SEE MECHANICAL DRAWINGS. | ALL DOWNSPOUTS TO DEAIN AWAY FROM THE BUILDING AS PER OBC 9.26.18.2. & 5.6.2.2.(3) AND MUNICIPAL STANDARDS. 3) ALL WINDOW WELLS TO DRAIN TO FOOTING LEVEL PER OBC

> STUD WALL REINFORCEMENT FOR FUTURE GRAB BARS IN MAIN BATHROOM
> REINFORCEMENT OF STUD WALLS SHALL BE INSTALLED REINFORCEMENT OF STUD WALLS SHALL BE INSTALLED
> ADJACENT TO WATER CLOSETS AND SHOWER OR BATHTUB IN
> MAIN BATHROOM. REFER TO OBC. 9.5.2.3, 3.8.3.8.(1)[d] &
> 3.8.3.13.[1][d], SEE DETAIL.
> 5) ALL EXTERIOR DOORS TO COMPLY WITH THERMAL RESISTANCE
> AS STATED IN O.B.C. SB-12-2.1.1.9.

ALL AIR BARRIER SYSTEMS ARE REQUIRED TO COMPLY WITH O.B.C. DIV.-8 9.25.3.

LUMBER: 1) ALL LUMBER SHALL BE SPRUCE NO.2 GRADE, UNLESS NOTED

2)

STUDS SHALL BE STUD GRADE SPRUCE, UNLESS NOTED

3) LUMBER EXPOSED TO THE EXTERIOR TO BE SPRUCE No.2 GRADE PRESSURE TREATED OR CEDAR, UNLESS NOTED OTHERWISE.

ALL LAMINATED VENEER LUMBER (L.V.L.) BEAMS, GIRDER TRUSSES, AND METAL HANGER CONNECTIONS SUPPORTI ROOF FRAMING TO BE DESIGNED & CERTIFIED BY TRUSS

LVL BEAMS SHALL BE 2.0E - 2950Fb MIN.. NAIL EACH PLY OF LVL WITH 897mm (3 1/2") LONG COMMON WIRE NAILS @ 300mm (12") O.C. STAGGERED IN 2 ROWS FOR 184, 240 & 300mm (7 1/4", 9 1/2". 11 7/8") DEPIHS AND STAGGERED IN 3 ROWS FOR GREATER DEPTHS AND FOR 4 PLY MEMBERS AND 13m DIA, GALVANIZED BOLTS BOLTED AT MID-DEPTH OF BEAM @

PROVIDE FACE MOUNT BEAM HANGERS TYPE "SCL"
MANUFACTURED BY SIMPSON STRONG-TIE OR EQUAL
FOR ALL LYL BEAM TO BEAM CONNECTIONS UNLESS
OTHERWISE NOTED. REFER TO ENG. FLOOR LAYOUTS.

JOIST HANGERS: PROVIDE METAL HANGERS FOR ALL JOISTS AND BUILT-UP WOOD MEMBERS INTERSECTING FLUSH BUILT-UP

WOOD MEMBERS.
WOOD FRAMING NOT TREATED WITH A WOOD PRESERVATIVE.
IN CONTACT WITH CONCRETE, SHALL BE SEPARATED FROM THE
CONCRETE BY AT LEAST 2 mill, POLYETHYLENE FILM, No. 50
(45lbs.) ROLL ROOFING OR OTHER DAMPPROOFING MATERIAL,
EXCEPT WHERE THE WOOD MEMBER IS AT LEAST 150mm (6")
ABOVE THE GROUND.

STRUCTURAL STEEL SHALL CONFORM TO CAN/CSA-G40-21 GRADE 300W. HOLLOW STRUCTURAL SECTIONS SHALL CONFORM TO CSA-G40.21 GRADE 350W "STRUCTURAL QUALITY STEEL". OBC. B-9.23.4.3. REINFORCING STEEL SHALL CONFORM TO CSA-G30-18M GRADE 400R.

GRADE AUDIC.

ALL STUCCO WALLS TO HAVE A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR. THE EXTERIOR SHEATHING MUST NOT BE GYPSUM BASED, ALL STUCCO TO BE INSTALLED AS PER MANUFACTURERS STUCCO: 1)

EXHAUST FAN

HEAVY DUTY OUTLET (220 volt)

Mint

S. J. BOYD

LIGHT FIXTURE (CEILING MOUNTED)

LIGHT FIXTURE (WALL MOUNTED)

TO EXTERIOR

**LEGEND** 0 • CLASS 'B' VENT DUPLEX OUTLET (HEIGHT A.F.F) DUPLEX OUTLET (12" ABOVE SURFACE) GFI DUPLEX OUTLET (HEIGHT A.F.F) WEATHERPROOF DUPLEX OUTLET POT LIGHT ◑

Z%

LIGHT FIXTURE (PULL CHAIN) SWITCH € FLOOR DRAIN 8

SJ

DJ

TJ

HOSE BIB (NON-FREEZE) SINGLE JOIST DOUBLE JOIST TRIPLE JOIST LAMINATED VENEER LUMBER

LVL ×6~ POINT LOAD FROM ABOVE P.T. PRESSURE TREATED

MAY 8, 2017 GIRDER TRUSS BY ROOF TRUSS MANUF. G.T.

EA. FLAT ARCH

\_\_\_\_ CURVED ARCH M.C. MEDICINE CABINET (RECESSED) 

CONC. BLOCK WALL XXXXX DOUBLE VOLUME WALL SEE NOTE (39.)

SOLID WOOD BEARING (SPRUCE No. 2).
SOLID BEARING TO BE AS WIDE AS SUPPORTED MEMBER OR AS DIRECTED BY STRUCTURAL ENGINEER SOLID BEARING TO BE MINIMUM 2 PIECES.



CONTRACTOR MUST VERIFY ALL DIMENSIONS ON THE JOB AND REPORT ANY DISCREPANCY TO VA3 DESIGN BEFORE PROCEEDING WITH THE WORK, ALL DRAWINGS AND SPECIFICATIONS ARE INSTRUMENTS OF SERVICE AND THE PROPERTY OF VA3 DESIGN WHICH IF REQUESTED MUST BE RETURNED AT THE COMPLETION OF THE WOR ALL DRAWINGS TO BE USED FOR CONSTRUCTION ONLY AFTER BUILDING PERMIT HAS BEEN ISSUED.

TWO STOREY VOLUME SPACES
-FOR A MAXIMUM 5490 mm (18-0") HEIGHT AND MAXIMUM SUPPORTED ROOF TRUSS LENGTH OF 6.0m, PROVIDE 2-38x140 (2-2"x6") SPR.#2 CONTIN. STUDS @ 300mm (12")
O.C. (TRIPLE UP AT EVERY THIRD DOUBLE STUD FOR BRICK
WALLS) C/W 9.6 (3/8") THICK EXT. PLYWOOD SHEATHING. PROVIDE SOLID WOOD BLOCKING BETWEEN WOOD STUDS © 1220 mm (4'-0") O.C. VERTICALLY. -FOR WALLS WITH HORIZ. DISTANCES NOT EXCEEDING 2900 mm (9'-6"), PROVIDE 38x140 (2"x6") STUDS @ 400 (16") O.C. WITH CONTINUOUS 2-38x140 (2-2"x6")TOP PLATES + 1-38x140 (1-2"x6") BOTTOM PLATE & MINIMUM OF 3-38x184 (3-2"x8")
CONT. HEADER AT GRND. CEILING LEVEL TOE-NAILED &
GLUED AT TOP, BOTTOM PLATES AND HEADERS.

TYPICAL 1 HOUR RATED PARTYWALL.
REFER TO DETAILS FOR TYPE AND SPECIFICATIONS.

FOUNDATION WALL (W.O.D./W.O.B.)
-FOR LATERAL SUPPORT WHERE GRADE TO T/O BASEMENT SLAB EXCEEDS 1200mm (3'-11") FOR 200mm (8") POURED CONC. FOUNDATION WALL PROVIDE VERTICAL 38x1 40 (2"x6") WOOD STUDS @ 400 (16")
o.c. MATCH FLOOR JOIST SPACING WHEN PARALLEL WITH
FLOOR JOIST. (RAMSET BOTTOM PLATE TO SLAB & FASTEN
TOP OF WALL TO FLOOR JOIST AND ALSO TIED TO 38x84 (2"x4") @ 300 (12") o.c. KNEE WALL]. REFER TO DETAIL.

EXTERIOR WALLS FOR WALK-OUT CONDITIONS THE EXTERIOR BASEMENT STUD WALL TO BE 38x140 (2"x6") STUDS @ 400mm (16") o.c. OR 38x89 (2"x4") STUDS @ 300mm

ONT. REG. 332/12-2012 OBC ♦ REVISED Amendment 0. Reg. 368/13 NOV. 13, 2014 WOOD LINTELS AND BUILT-UP WOOD BEAMS 2/38 × 184 (2/2" × 8") SPR.#2 3/38 × 184 (3/2" × 8") SPR.#2 4/38 × 184 (4/2" × 8") SPR.#2 5/38 × 184 (5/2" × 8") SPR.#2 B7 2/38 × 235 (2/2" × 10") SPR.#2 3/38 × 235 (3/2" × 10") SPR.#2 4/38 × 235 (4/2" × 10") SPR.#2 L3 2/38 × 286 (2/2" × 12") SPR.#2 3/38 × 286 (3/2" × 12") SPR.#2 4/38 × 286 (4/2" × 12") SPR.#2 LOOSE STEEL LINTELS

90 x 90 x 6.0L (3-1/2" x 3-1/2" x 1/4"L) 90 x 90 x 8.0L (3-1/2" x 3-1/2" x 5/16"L) 100 x 90 x 8.0L (4" x 3-1/2" x 5/16"L) 125 x 90 x 8.0L (5" x 3-1/2" x 5/16"L) 152 x 89 x 10.0L (6" x 3-1/2" x 3/8"L) 150 x 100 x 10.0L (6"x 4" x 3/8"L) 180 x 100 x 10.0L (7"x 4" x 3/8"L) L12 LAMINATED VENEER LUMBER (LVL) BEAMS

LAMINATED VENEER LUMBER (LV
LVL1A 1-1 3/4"x7 1/4" (1-45x184)
LVL1 2-1 3/4"x7 1/4" (2-45x184)
LVL2 3-1 3/4"x7 1/4" (3-45x184)
LVL3 4-1 3/4"x7 1/4" (4-45x184)
LVL4A 1-1 3/4"x9 1/2" (1-45x240)
LVL4 2-1 3/4"x9 1/2" (2-45x240)
LVL5 3-1 3/4"x9 1/2" (3-45x240)
LVL5 3-1 3/4"x1 17/8" (3-45x240)
LVL6A 1-1 3/4"x11 7/8" (1-45x300)
LVL6 2-1 3/4"x11 7/8" (1-45x300)
LVL7 3-1 3/4"x11 7/8" (3-45x300)
LVL8 4-1 3/4"x11 7/8" (4-45x300)
LVL8 4-1 3/4"x11 7/8" (4-45x300)
LVL8 4-1 3/4"x11 7/8" (4-45x300)

DOOR SCHEDULE 

1B EXTERIOR 915 x 2030 x 45 DOOR (3'-0" x 6'-8" x EXTERIOR 915 x 20.50 x 95
DOOR (3"-0" x 6"-8" x 1-3/4")
INSULATED MIN. RSI 0.7 (R4)
EXTERIOR 915 x 24.58 x 45
DOOR (3"-0" x 8"-0" x 1-3/4")
INSULATED MIN. RSI 0.7 (R4)
INTERIOR 815 x 20.50 x 35
DOOR (2"-6" x 6"-6" x 1-3/6")
INTERIOR 815 x 20.50 x 35
DOOR (2"-6" x 6"-6" x 1-3/6")
EVENTERIOR 815 x 20.50 x 35
EVENTERIOR 815 x 20.50 x 35 1C EXTERIOR DOOR

(1D)

(2.) 2A DOOR (2'-8" x 6'-8" x 1-3/4") 20
MIN. RATED DOOR AND FRAME,
WITH APPROVED SELF CLOSING

DEVICE. 815 x 2030 x 45 (2'-8" x 6'-8" x 1-3/4") EXTERIOR DOOR (2B) (WEATHER STRIPPING INSTALLED) 815 x 2438 x 45 (2'-8" x 8'-0" x 1-3/4")

(2C) EXTERIOR 815 x 2438 x 45

DOOR (2'-8" x 8'-0" x 1-3/4") 20

MIN. RATED DOOR AND FRAME,
WITH APPROVED SELF CLOSING (2D)

DEVICE. 760 x 2030 x 35 (2'-6" x 6'-8" x 1-3/8") (3.) INTERIOR 710 x 2030 x 35 DOOR (2'-4" x 6'-8" x 1-3/8") (3A)

INTERIOR 760 x 2438 x 35 DOOR (2'-6" x 8'-0" x 1-3/8") (3B) DOOR INTERIOR 710 x 2438 x 35 DOOR (2'-4" x 8'-0" x 1-3/8") (3C) INTERIOR 610 x 2030 x 35 DOOR (2'-0" x 6'-8" x 1-3/8") (4.)

INTERIOR 660 x 2030 x 35 DOOR (2'-2" x 6'-8" x 1-3/8") (4A) INTERIOR 680 x 2438 x 35 DOOR (2'-2" x 8'-0" x 1-3/8") (4C)

5. INTERIOR 460 x 2030 x 35 DOOR (1'-6" x 6'-8" x 1-3/8") EXTERIOR 815 x 2030 x 45 DOOR (2'-8" x 6'-8" x 1-3/4") SOLID WOOD CORE (6.) DOOR

MECHANICAL SYMBOLS -480 HEAT PIPE WARM AIR RETURN AIR DUCT PLUMBING (TOILET) PLUMBING (BATH, NK,SHOWER)

SMOKE ALARM (REFER TO ORC 9.10.19) PROVIDE 1 PER FLOOR, NEAR THE STAIRS CONNECTING THE FLOOR LEVEL AND ALSO 1 IN EACH BEDROOM NEAR HALL DOOR, ALARMS TO BE CONNECTED TO AN ELECTRICAL CIRCUIT AND INTERCONNECTED TO ACTIVATE ALL ALARMS IF 1 SOUNDS. BATTERY BACK-UP REQUIRED. SMOKE ALARMS TO INCORPORATE VISUAL

SIGNALLING COMPONENT (9.10.19.3.(3)). CARBON MONOXIDE ALARMS (OBC 9.33.4.)

WHERE A FUEL-BURNING APPLIANCE IS INSTALLED IN A DWELLING UNIT, A CARBON MONOXIDE ALARM CONFORMING TO CAN./CSA-6.19 OR UL2034 SHALL BE INSTALLED ADJACENT TO EACH SLEEPING AREA, CARBON MONOXIDE DETECTOR(S) SHALL BE PERMANENTLY WIRED SO THAT ITS ACTIVATION WILL ACTIVATE ALL CARBON MONOXIDE DETECTORS AND BE EQUIPPED WITH AN ALARM THAT IS AUDIBLE WITHIN BEDROOMS WHEN THE INTERVENING DOORS ARE CLOSED. REFER TO MANUFACTURER FOR ADDDITIONAL REQUIREMENTS

SOIL GAS/ RADON CONTROL (OBC 9.1.1.7. & 9.13.4.)
PROVIDE CONSTRUCTION TO PREVENT LEAKAGE OF SOIL GAS INTO THE BUILDING IF REQUIRED.

REFER TO ENERGY STAR BOP FOR The minimum thermal performance of building envelope and equipment shall conform to the selected package unless otherwise noted.

VA3 REFERENCE NUMBER

2 UPDATE TO CODE APR 16-15 RC 1 ISSUE FOR CLIENT REVIEW MAY 07-14 RC no. description date by

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. ualification information Wellington Jno-Baptiste JABOFILSTE 25591 signatyre VA3 Design Inc. 42658 Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.

(\* SEE OBC 9.23.9.4. \*)





va3design.com

**BAYVIEW WELLINGTON** 

CONST NOTE 13045

**GREEN VALLEY ESTATES** BRADFORD date APR 2014 **CONSTRUCTION NOTES** RC 3/16" = 1'-0"13045-CONST-OBC 2015

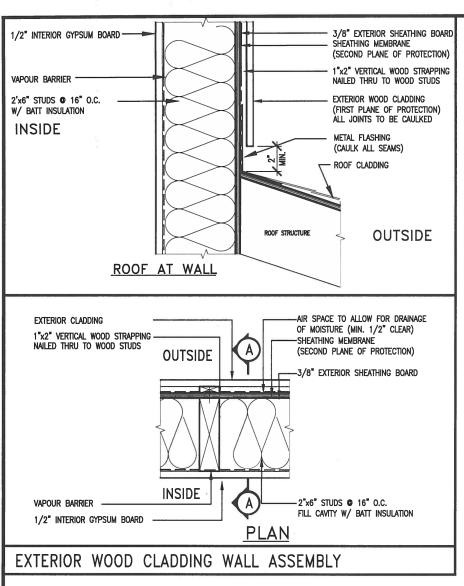

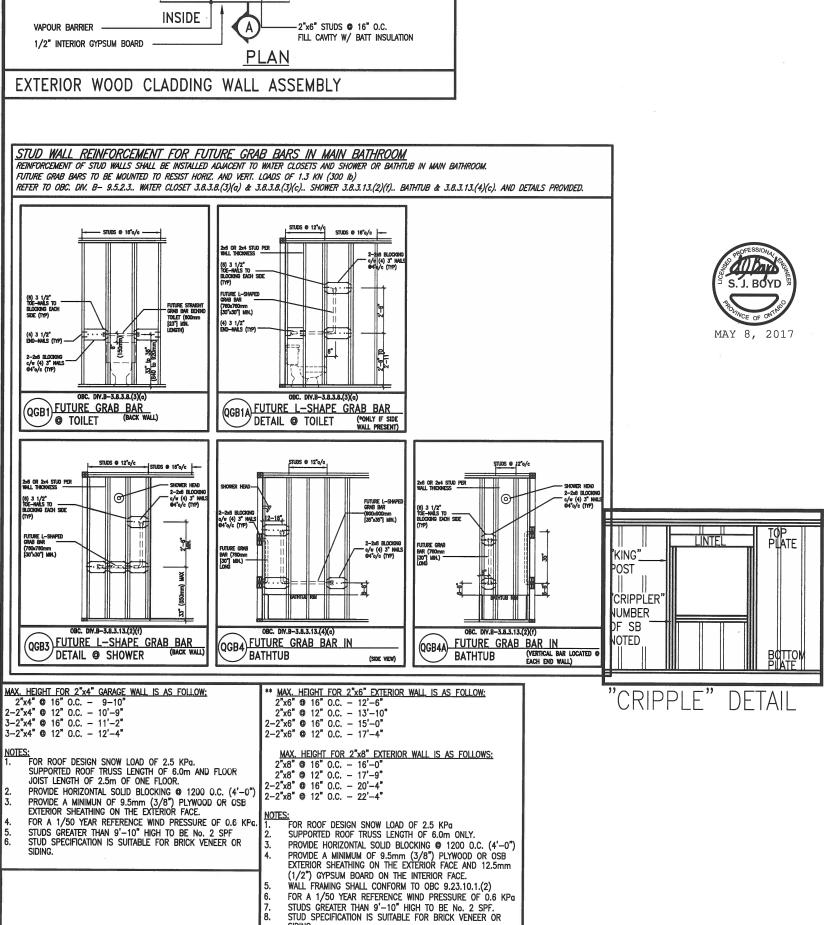

\*\* STUD INFORMATION TAKEN FROM OBC TABLE A-30

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. qualification information

Wellington Jno-Baptiste 6 25591 BCI VA3 Design Inc. 42658 3 Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled. 2 UPDATE TO CODE APR 16-15 RC 1 ISSUE FOR CLIENT REVIEW MAY 07-14 RC no. description date



RC


<b>BAYVIEW</b>	WELLINGTON

**CONST NOTE** 


**GREEN VALLEY ESTATES** BRADFORD date APR 2014 3/16" = 1'-0" drawn by checked by

CONSTRUCTION NOTES 13045-CONST-OBC 2015

project no. 13045

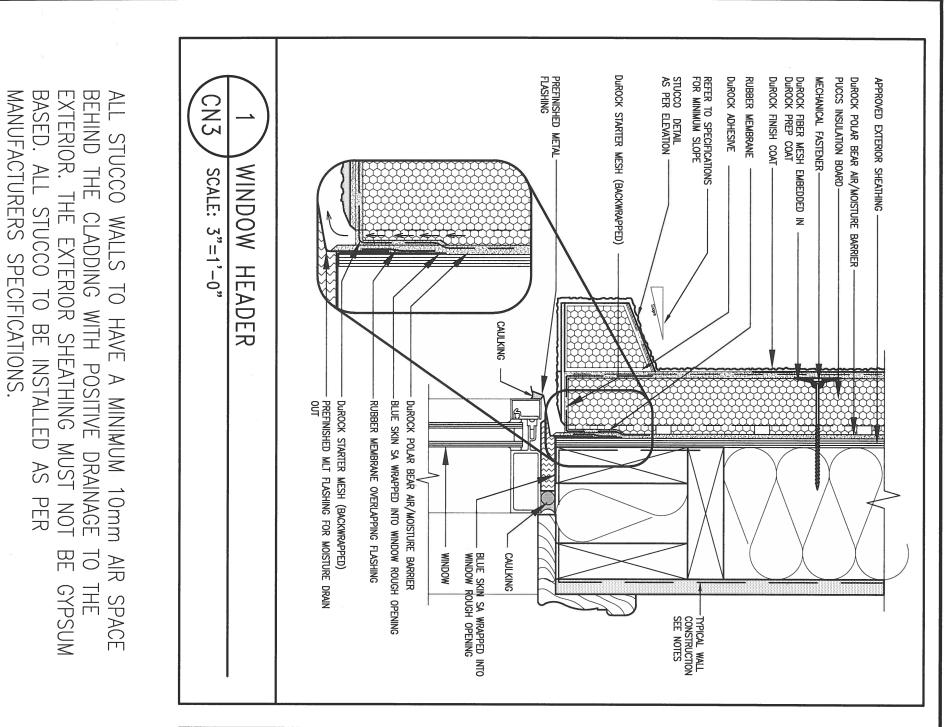

DETAILS ARE BASED ON DUROCK PUCCS SYSTEM

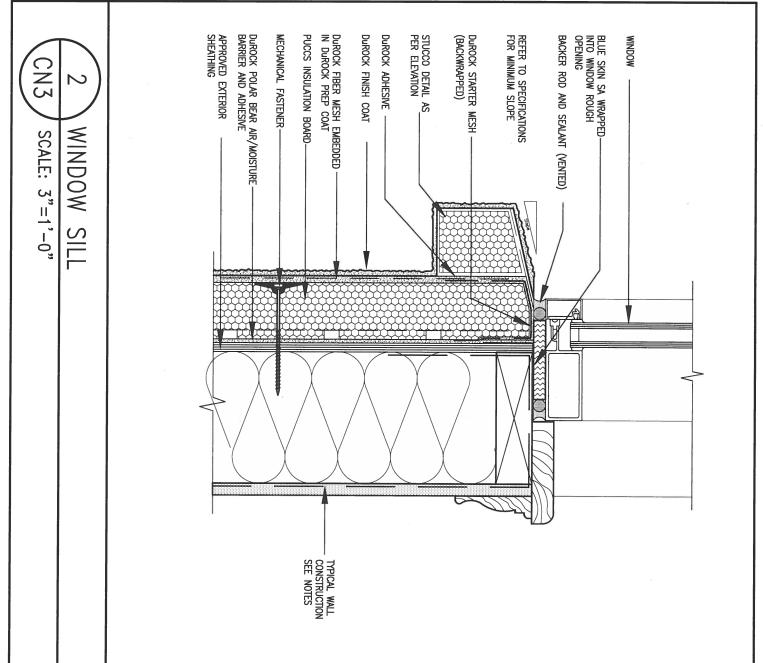

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. **BAYVIEW WELLINGTON** Wellington Jno-Baptiste 25591 name registration information VA3 Design Inc. BCIN **GREEN VALLEY ESTATES** 42658 APR 2014 Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled. 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 UPDATE TO CODE APR 16-15 RC 3/16" = 1'-0" 1 ISSUE FOR CLIENT REVIEW MAY 07-14 RC no. description date by va3design.com

BRADFORD CONSTRUCTION NOTES 13045-CONST-OBC 2015 RICHARD - H:\ARCHIVE\WORKING\2013\13045.BW\units\13045-CONST-OBC 2015.dwg - Tue - Dec 20 2016 - 9:19 AM

**CONST NOTE** 


13045

DUROCK FIBRE MESH EMBEDDED IN DUROCK PREP COAT 2 1/2" THICK PUCCS INSULATION BOARD DUROCK STARTER MESH (BACKWRAPPED) DUROCK "POLAR BEAR"
AIR/MOISTURE BARRIER/ADHESIVE DUROCK FINISH COAT APPROVED EXTERIOR SHEATHING MECHANICAL FASTENER STUCCO TERMINATION SCALE: 3"=1'-0" **@** ROOF FLASHING

ALL STUCCO WALLS TO HAVE A MINIMUM 10mm AIR SPACE

EXTERIOR. THE EXTERIOR SHEATHING MUST NOT BE GYPSUM BASED. ALL STUCCO TO BE INSTALLED AS PER MANUFACTURERS SPECIFICATIONS. DETAILS ARE BASED ON DUROCK PUCCS SYSTEM

2 UPDATE TO CODE

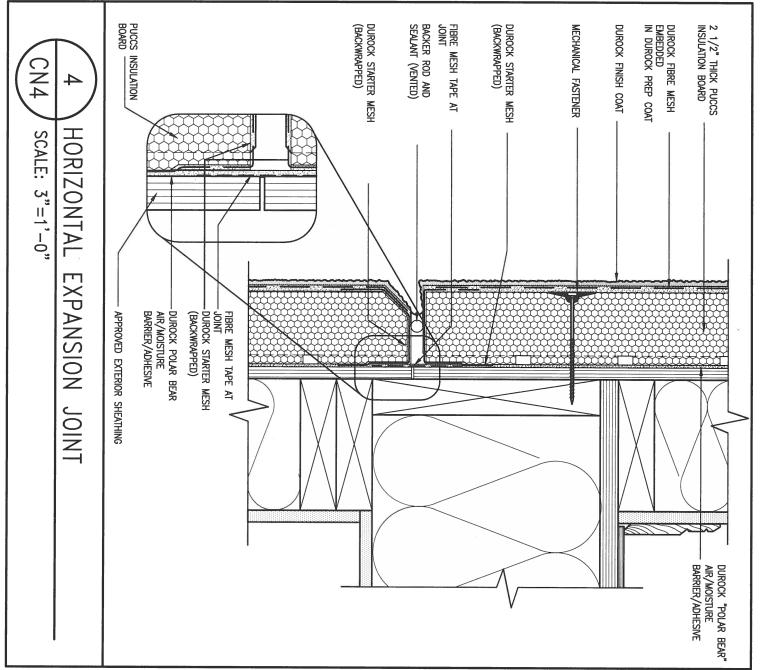


The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. **CONST NOTE BAYVIEW WELLINGTON** Wellington Jno-Baptiste 25591 BCIN **GREEN VALLEY ESTATES** BRADFORD VA3 Design Inc. 13045 42658 date APR 2014 Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled. CONSTRUCTION NOTES 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 APR 16-15 RC drawn by 1 ISSUE FOR CLIENT REVIEW MAY 07-14 RC t 416.630.2255 f 416.630.4782 va3design.com 3/16" = 1'-0"13045-CONST-OBC 2015 by RICHARD - H:\ARCHIVE\WORKING\2013\13045.BW\units\13045-CONST-OBC 2015.dwg - Tue - Dec 20 2016 - 9:19 AW All drawings specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission APPROVIDE DITIERS:


APPROV

ALL STUCCO WALLS TO HAVE A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR. THE EXTERIOR SHEATHING MUST NOT BE GYPSUM BASED. ALL STUCCO TO BE INSTALLED AS PER MANUFACTURERS SPECIFICATIONS.

DETAILS ARE BASED ON DUROCK PUCCS SYSTEM

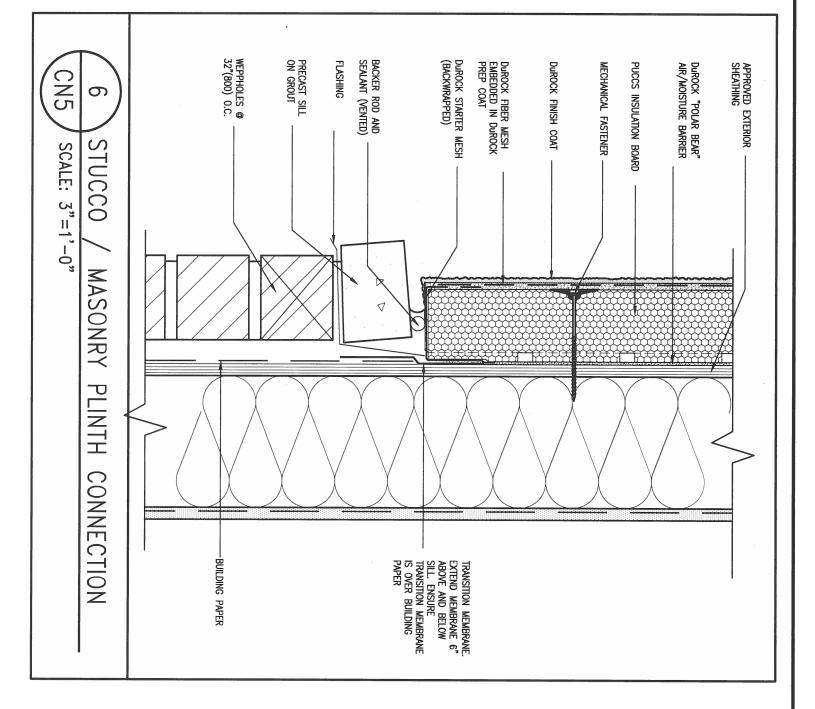


**CONST NOTE BAYVIEW WELLINGTON** Wellington Jno-Baptiste 25591 project no. 13045 BCIN municipality BRADFORD **GREEN VALLEY ESTATES** VA3 Design Inc. 42658 date APR 2014 Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled. CONSTRUCTION NOTES 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 2 UPDATE TO CODE APR 16-15 RC drawn by RC 3/16" = 1'-0" 1 ISSUE FOR CLIENT REVIEW MAY 07-14 RC 13045-CONST-OBC 2015 no. description date by va3design.com RICHARD - H:\ARCHIVE\WORKING\2013\13045.BW\units\13045-CONST-OBC 2015.dwg - Tue - Dec 20 2016 - 9:19 AM

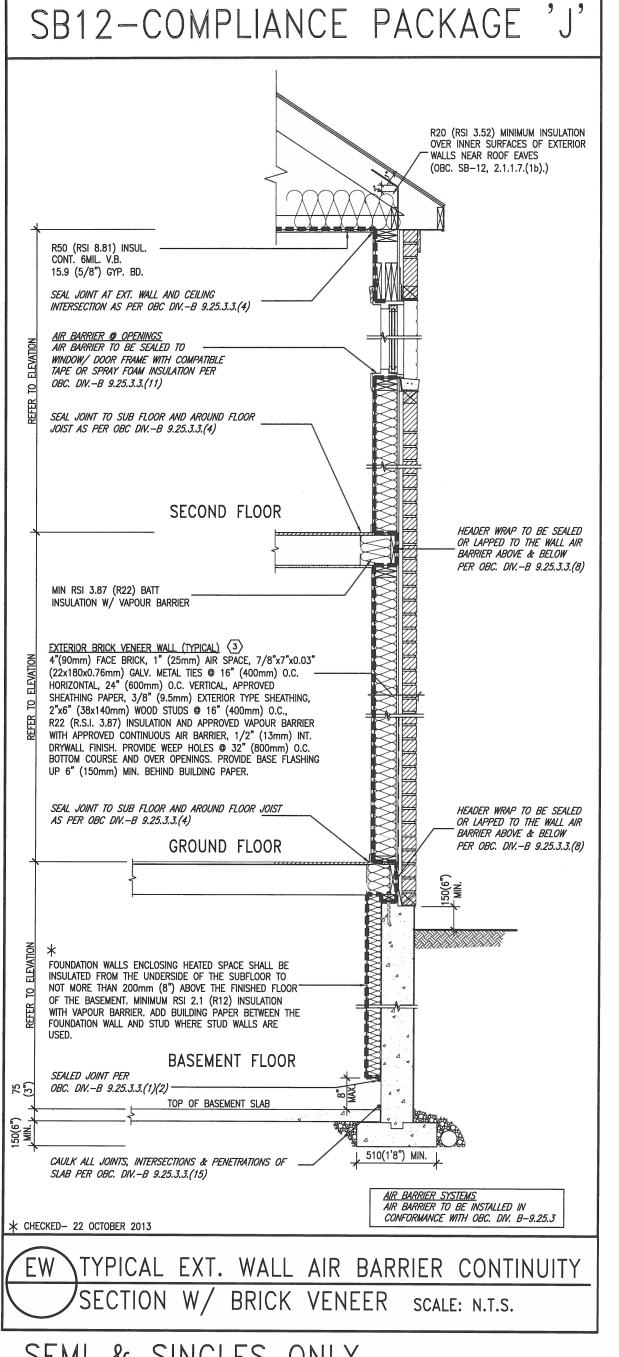

THE MINIMAL THERMAL PERFORMANCE OF BUILDING ENVELOPE AND EQUIPMENT SHALL CONFORM TO THE FOLLOWING SB-12 COMPLIANCE PACKAGE AS PER OBC SUPPLEMENTARY STANDARD SB-12, SECTION 2.1.1.1

USE SB-12 COMPLIANCE PACKAGE (J):				
COMPONENT	J	Notes:		
Ceiling with Attic Space Minimum RSI (R) value	8.81 (R50)	BLOWN -LOOSE		
Ceiling without Attic Space Minimum RSI (R) value	5.46 (R31)	BATT or SPRAY		
Exposed FLoor Minimum RSI (R) value	5.46 (R31)	BATT or SPRAY		
Walls Above Grade Minimum RSI (R) value	3.87 (R22)	6" R22 BATT		
Basement Walls Minimum RSI (R) value	2.11 (R12)	4" R12 BLANKET		
Edge of Below Grade Slab ≤600mm below grade Minimum RSI (R) value	1.76 (R10)	RIGID INSUL		
Windows & Sliding glass Doors Maximum U—value	1.8	DOUBLE PANE LOW EMISSIVITY		
Skylights Maximum U-value	2.8	DOUBLE PANE LOW EMISSIVITY		
Space Heating Equipment Minimum AFUE	94%	NATURAL GAS		
Hot Water Heater Minimum EF	0.67	NATURAL GAS		
HRV Minimum Efficiency	60%	_		



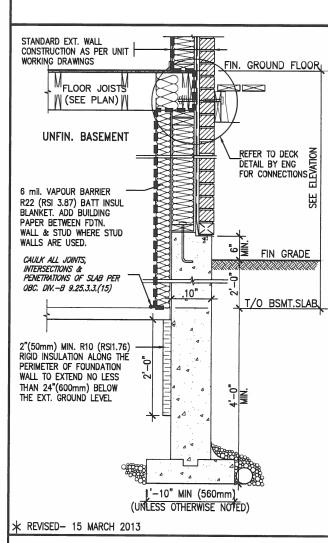

SECTION AT W.O.D/W.O.B.

# SEMI & SINGLES ONLY

			' '		
9				The undersigned has reviewed and takes responsibility for this design	Γ
8				and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.	ı
7	•			qualification information	
6				Wellington Jno-Baptiste / 180516576 25591	
5				name signature BCIN	ı
4				registration information VA3 Design Inc. 42658	ı
3					l
2	UPDATE TO CODE	APR 16-15	RC	Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All	ı
1	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC		ŀ
no.	description	date	by	Drawings are not to be scaled.	L

255 Consumers Rd Suite 120 Toronto ON M2J 1R4 416.630.2255 f 416.630.4782


BAYVIEW	WELLINGTON	
ne	municipality	


CONST NOTE

**GREEN VALLEY ESTATES** BRADFORD APR 2014 CONSTRUCTION NOTES drawn by RC 3/16" = 1'-0"


13045-CONST-OBC 2015


13045

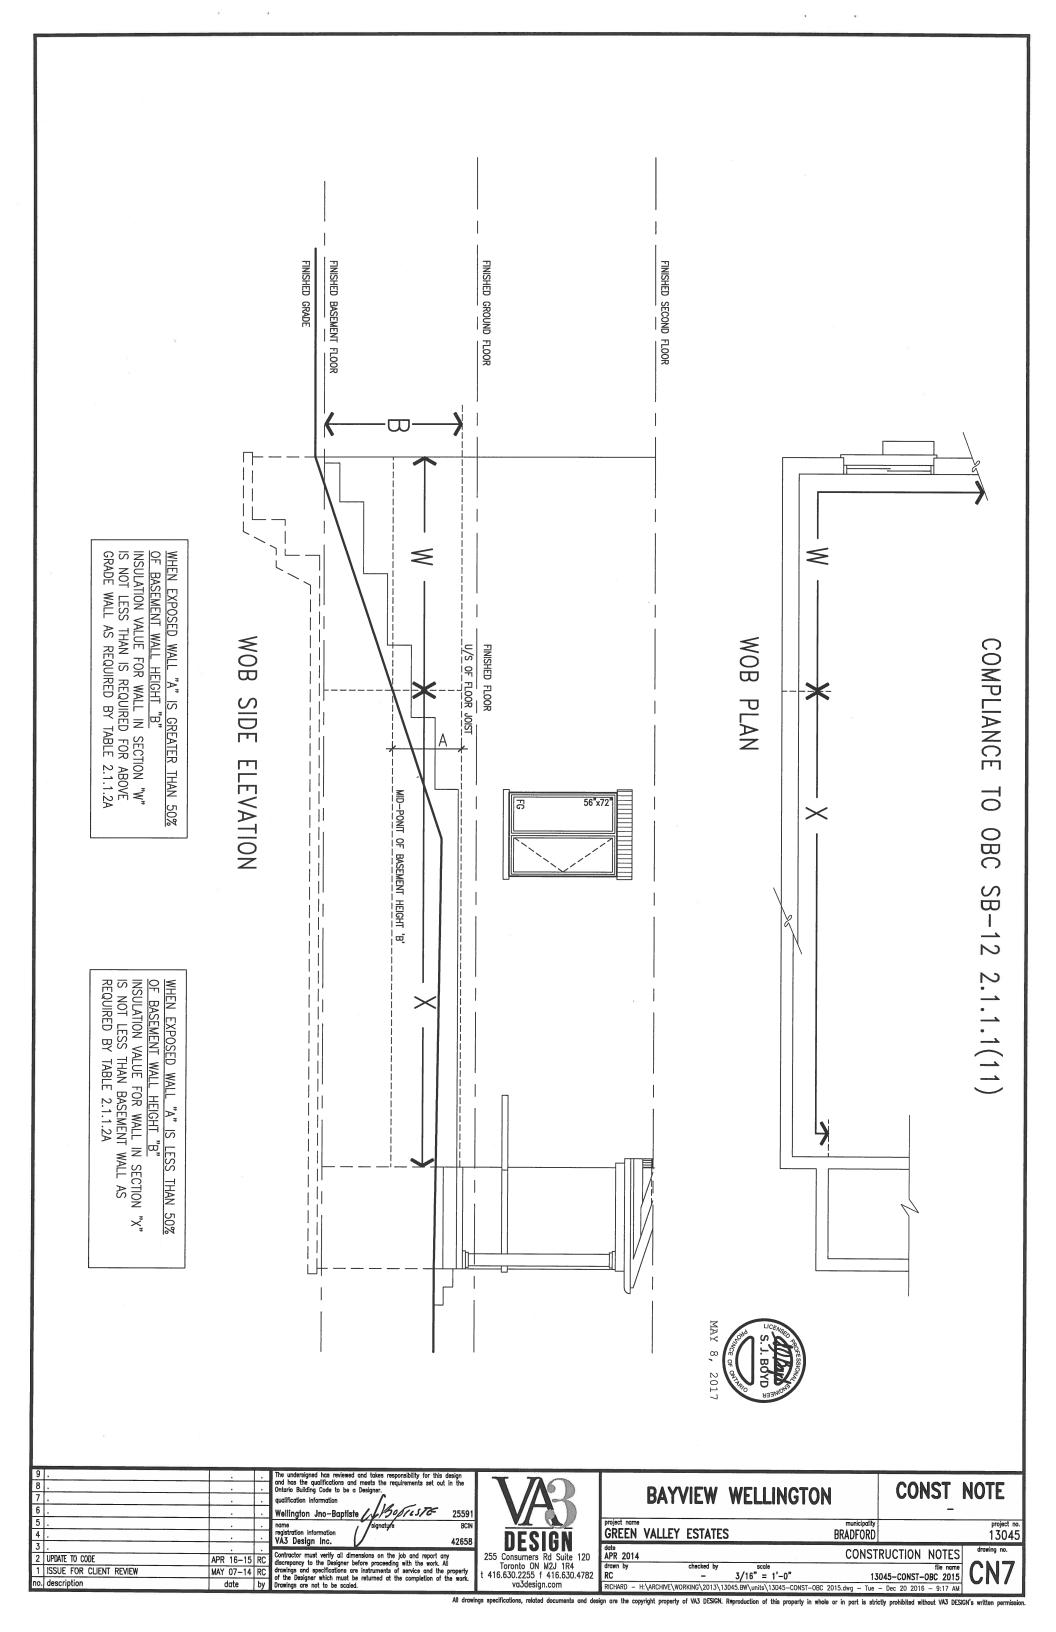


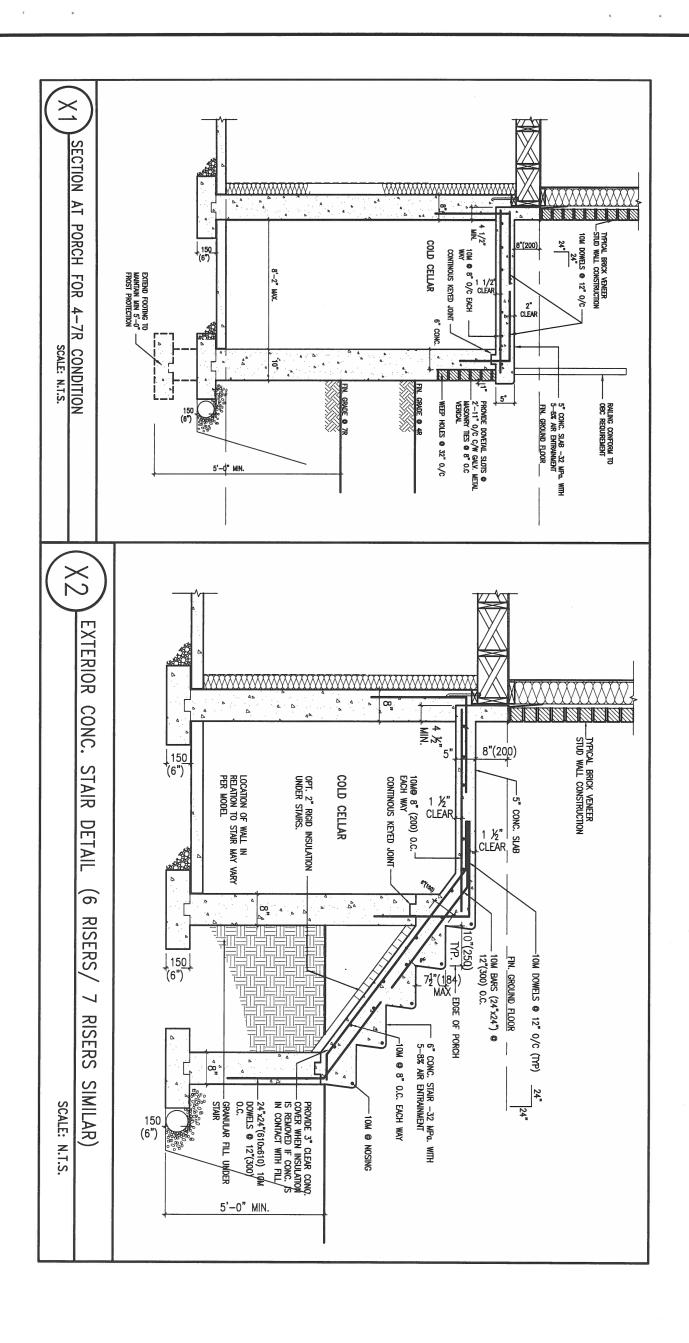



9 . 8 . 7 . 6 .		The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.  qualification information  Wellington Jno-Baptiste Language 2559:	VAR	BAYVIEW WELLINGTON	CONST_NOTE
5 . 4 . 3 .		name signature BCIN Pagistration information VA3 Design Inc.	DESIGN	GREEN VALLEY ESTATES  BRADF	ORD 13045
2 UPDATE TO CODE 1 ISSUE FOR CLIENT REVIEW no. description	MAY 07-14 RC	Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.	255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 va3design.com	APR 2014 CO drawn by checked by scale	13045-CONST-OBC 2015

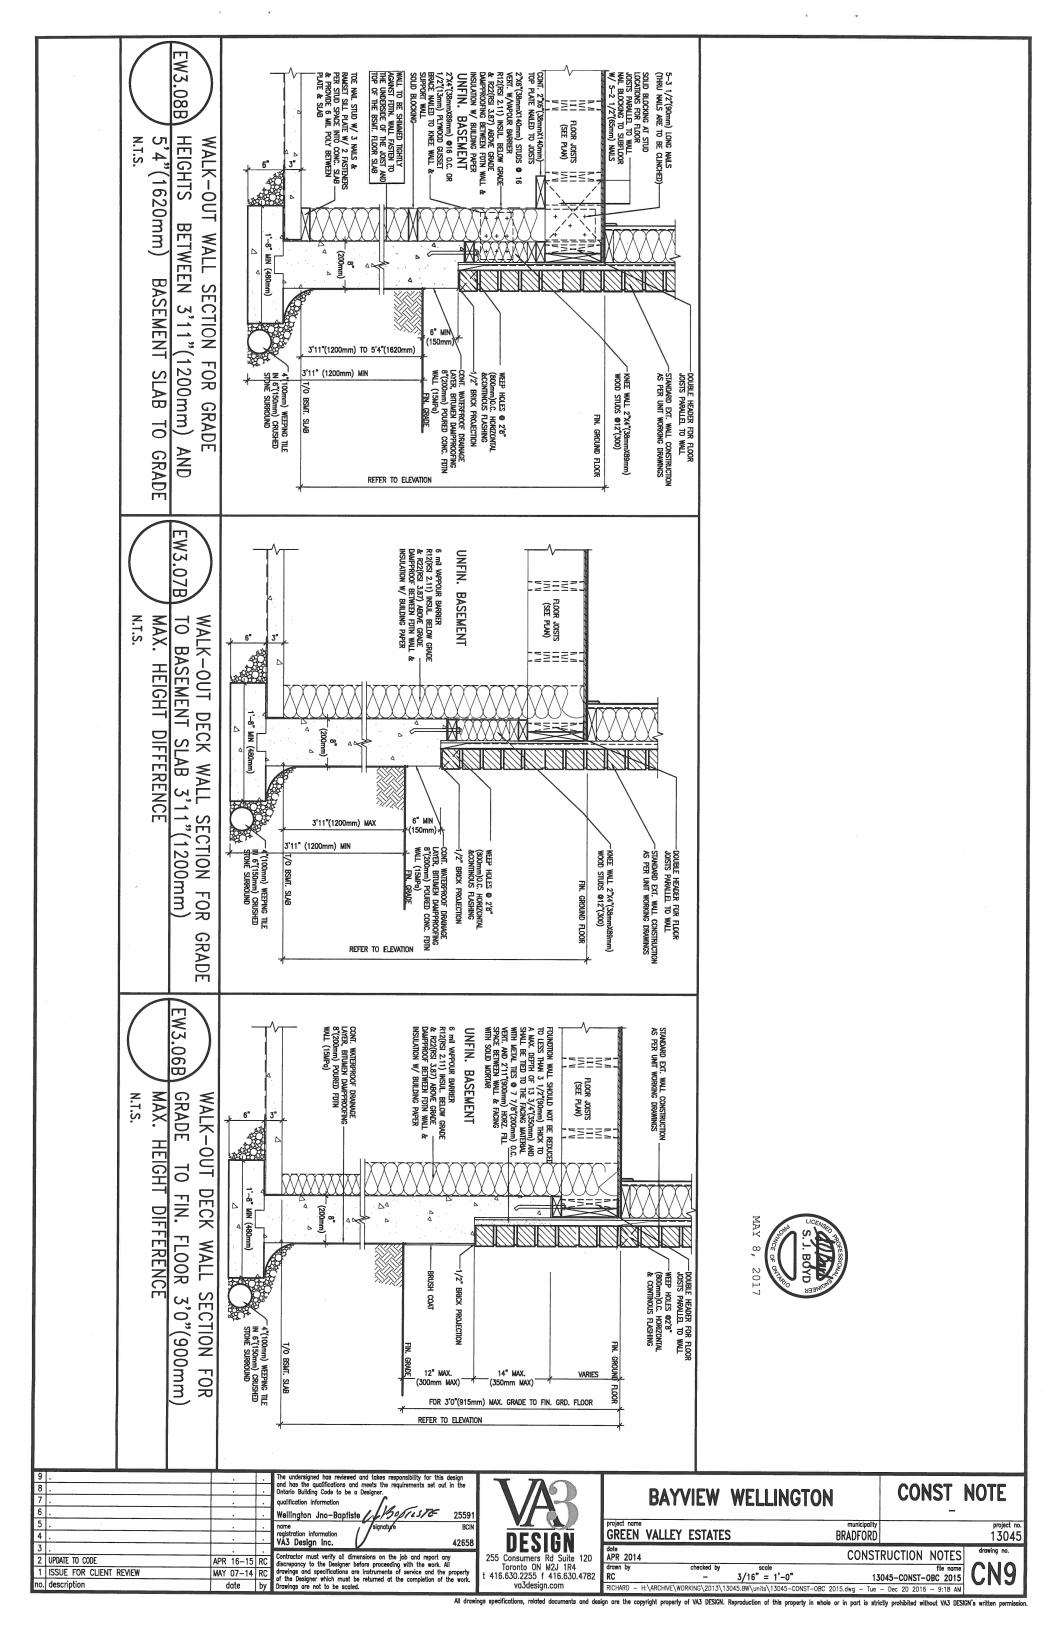


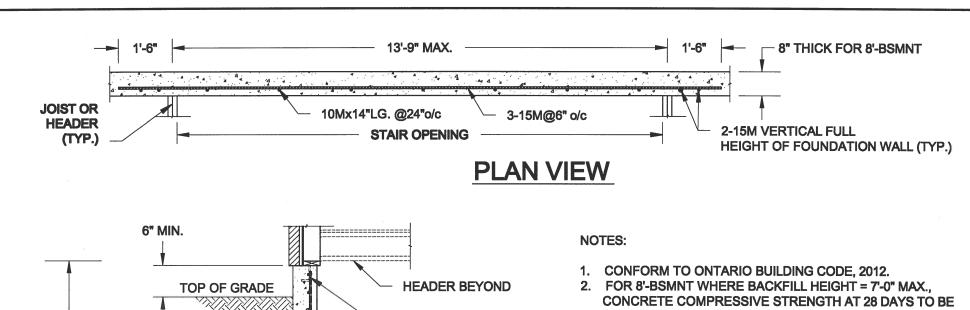


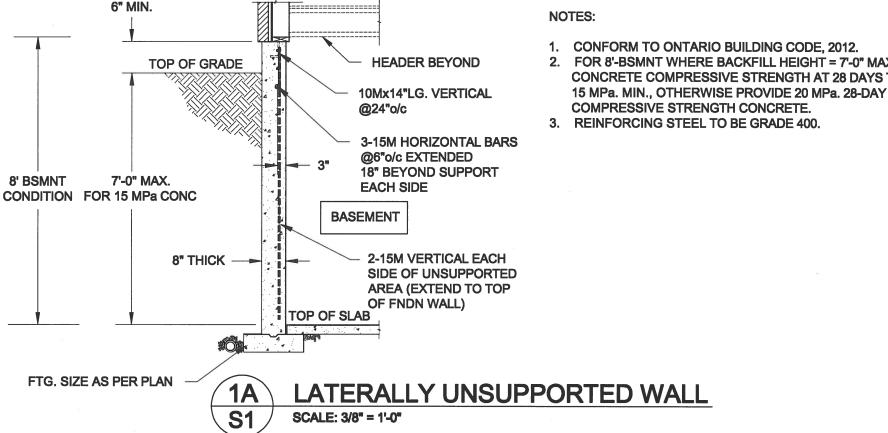

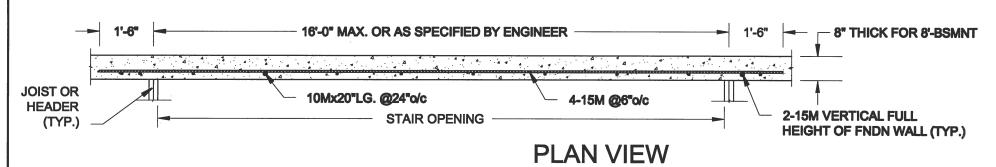

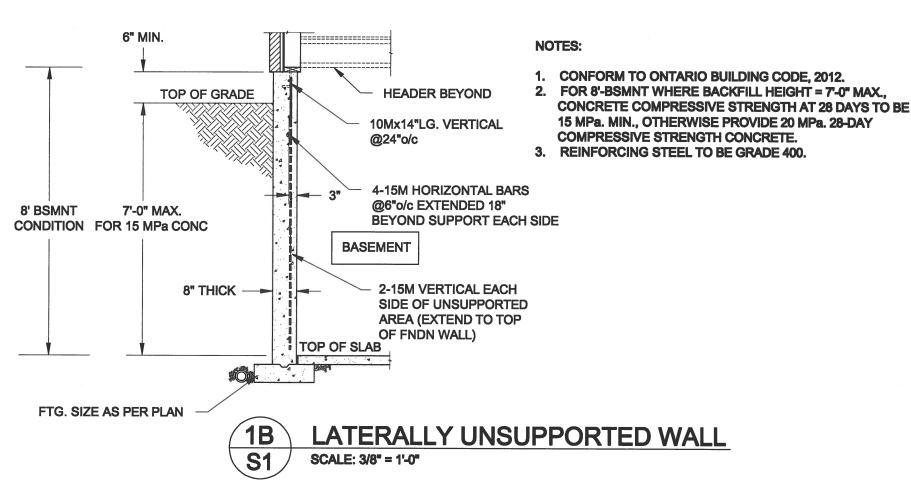

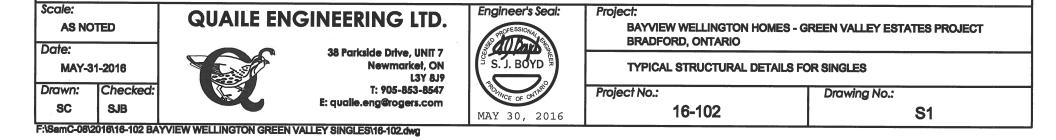


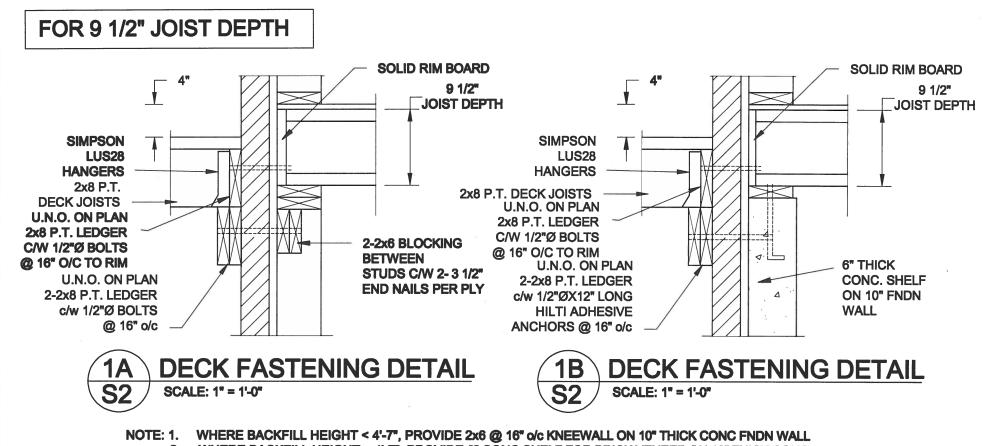

WHERE BACKFILL HEIGHT > 4'-7", PROVIDE 6" CONC SHELF FOR BRICK VENEER ON 10" THICK CONC FNDN WALL

FOOTING TO BE 22"x6" THICK UNLESS NOTED OTHERWISE ON PLAN. 3.



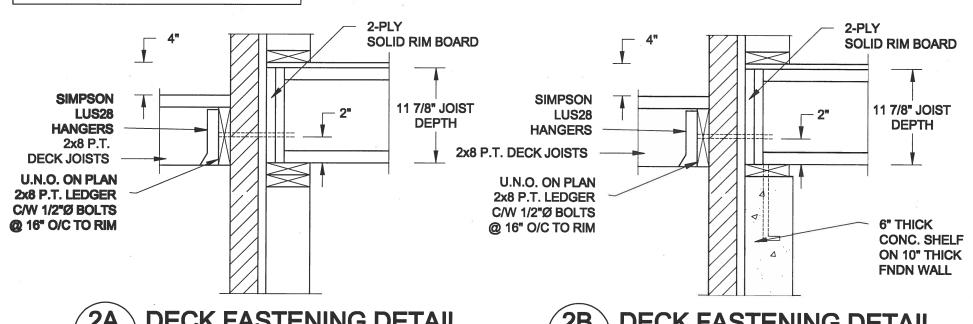


**DECK FASTENING DETAIL** SCALE: 1" = 1'-0"

**DECK FASTENING DETAIL** SCALE: 1" = 1'-0"


WHERE BACKFILL HEIGHT < 4'-7", PROVIDE 2x6 @ 16" o/c KNEEWALL ON 10" THICK CONC FNDN WALL

WHERE BACKFILL HEIGHT > 4'-7", PROVIDE 6" CONC SHELF FOR BRICK VENEER ON 10" THICK CONC FNDN WALL 2.

FOOTING TO BE 22"x6" THICK UNLESS NOTED OTHERWISE ON PLAN.

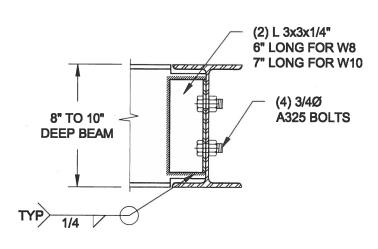

NOTE: DETAIL IS APPLICABLE TO W8x40 (W200x59) BEAM MAX AND W10x39 (W250x58) BEAM MAX.

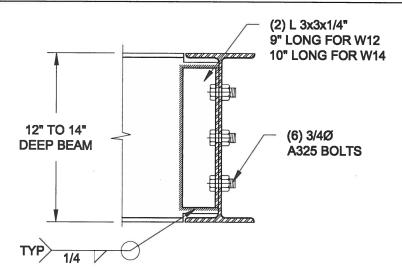

NOTE: DETAIL IS APPLICABLE TO W12x58 (W310x86) BEAM MAX AND W14x48 (W360x72) BEAM MAX.




# STEEL BEAM CONNECTION DETAIL


SCALE: 1-1/2" = 1'-0"

Scale: Engineer's Seat: Project: QUAILE ENGINEERING LTD. **AS NOTED BAYVIEW WELLINGTON HOMES - GREEN VALLEY ESTATES PROJECT BRADFORD, ONTARIO** 38 Parkside Drive, UNIT 7 S. J. BOYD Newmarket, ON MAY-31-2016 TYPICAL STRUCTURAL DETAILS FOR SINGLES L3Y 8J9 Drawn: Checked T: 905-853-8547 Project No.: Drawing No.: E: qualle.eng@rogers.com **8**C 8.11 16-102 82 MAY 30, 2016


and overtens has mayyew welling for green walley engleship for due

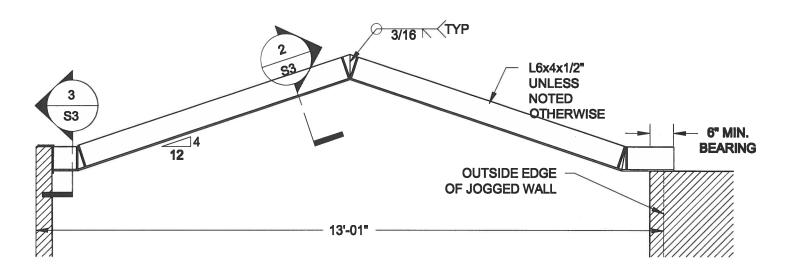






2 TYP. STIFFENER
S3 SCALE: 1 1/2" = 1'-0"

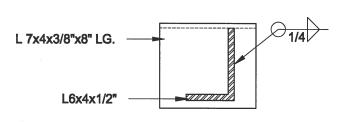

3 INVERTED ANGLE
S3 SCALE: 1 1/2" = 1'-0"

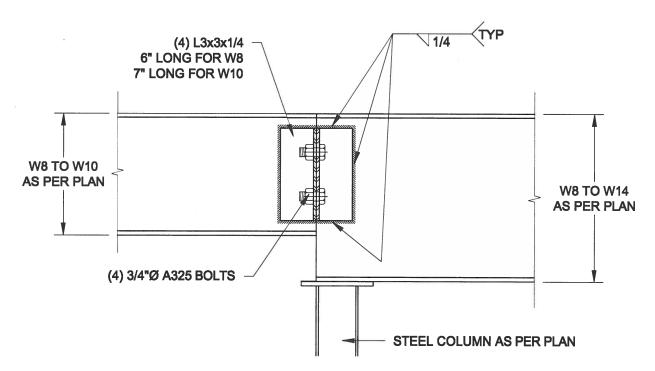

4 STEEL BEAM CONNECTION
SCALE: 1 1/2" = 1'-0"

Scale: AS NOTED Date:

MAY-81-2016

Drawn: Checked: 8C 8JB

# QUAILE ENGINEERING LTD.






Project:
BAYVIEW WELLINGTON HOMES - GREEN VALLEY ESTATES PROJECT
BRADFORD, ONTARIO

TYPICAL STRUCTURAL DETAILS FOR SINGLES

Project No.: Drawing No.:

16-102 83

PANEMO-GOEDHONO-1022 BAYVIEW WELLINGTON GREEN WALLEY GINGLE MO-10224

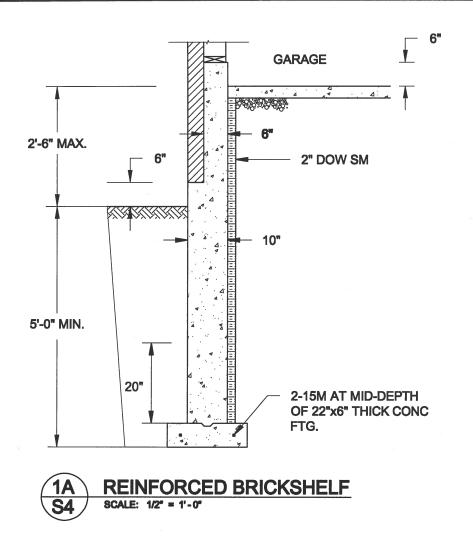

# 5'-6" MAX. 6" 15M@12"o/c VERTICAL & HORIZONTAL 10" 2" DOW SM 6" 15M DOWELS@12"o/c 2-15M AT MID-DEPTH OF 22"x6" THICK CONC FTG.

2-15M @ TOP OF WALL

**GARAGE** 

0000000


6"

1B REINFORCED BRICKSHELF S4 SCALE: 1/2" = 1'-0"


### NOTE:

- 1. CONFORM TO ONTARIO BUILDING CODE, 2012.
- 2. CONCRETE TO HAVE 28-DAY COMPRESSIVE STRENGTH OF 20 MPa.
- 3. REINFORCING BARS TO BE GRADE 400 DEFORMED STEEL.
- 4. PROVIDE 3" COVER TO SOIL MINIMUM.

## FOR 9 1/2" JOIST DEPTH

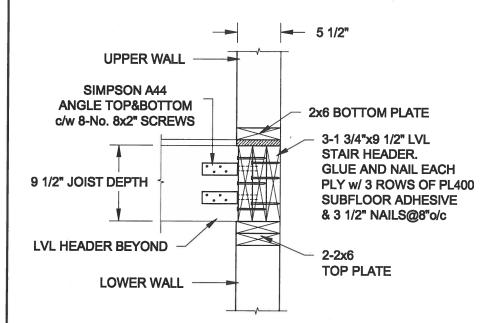

# FOR 11 7/8" JOIST DEPTH

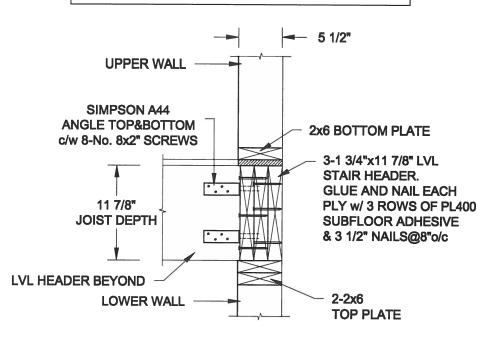

2 STAIR HEADER @ EXTERIOR WALL
S4 SCALE: 1" = 1'-0"

Scale:
AS NOTED

Date:
MAY-81-2016

Drawn: Checked:
SC SJB

# QUAILE ENGINEERING LTD.



38 Parkside Drive, UNIT 7 Newmarket, ON L3Y 8J9 T: 905-853-8547 E: qualle.eng@rogers.com



Project:


BAYVIEW WELLINGTON HOMES - GREEN VALLEY ESTATES PROJECT BRADFORD, ONTARIO

TYPICAL STRUCTURAL DETAILS FOR SINGLES

Project No.: Drawing No.:

16-102 84

PHOLING-GOOD HONG-FOR BAYVIEW WELLINGTON GREEN WALLEY SINGLES (0-1024)

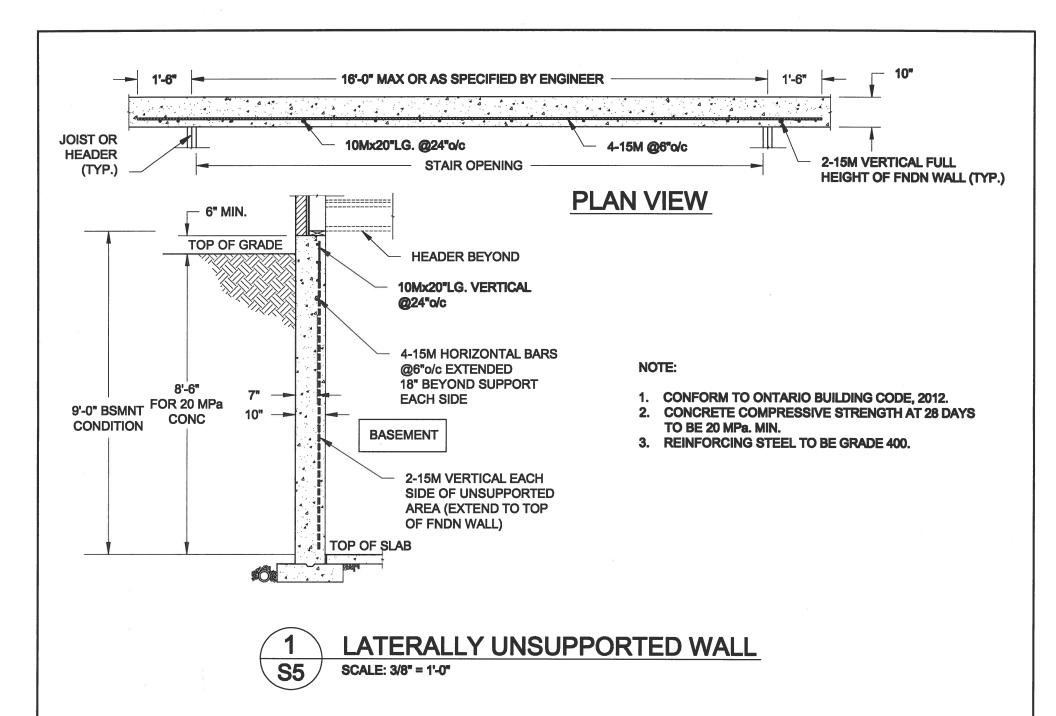

Scale: Engineer's Seat: Project: **QUAILE ENGINEERING LTD. AS NOTED** BAYVIEW WELLINGTON HOMES - GREEN VALLEY ESTATES PROJECT BRADFORD, ONTARIO Date: 38 Parkside Drive, UNIT 7 S. J. BOYD MAY-31-2016 Newmarket, ON TYPICAL STRUCTURAL DETAILS FOR SINGLES L3Y 8J9 Drawn: T: 905-853-8547 Project No.: Drawing No.: E: qualle.eng@rogers.com **8**C 8.13 MAY 30, 2016 16-102 **S**5