


It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (setting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Town of Bradford / West Gwillimbury.

ARCHITECTURAL REVIEW APPROVAL

JUN 1 2 2017

John G. W. Limited, Architect

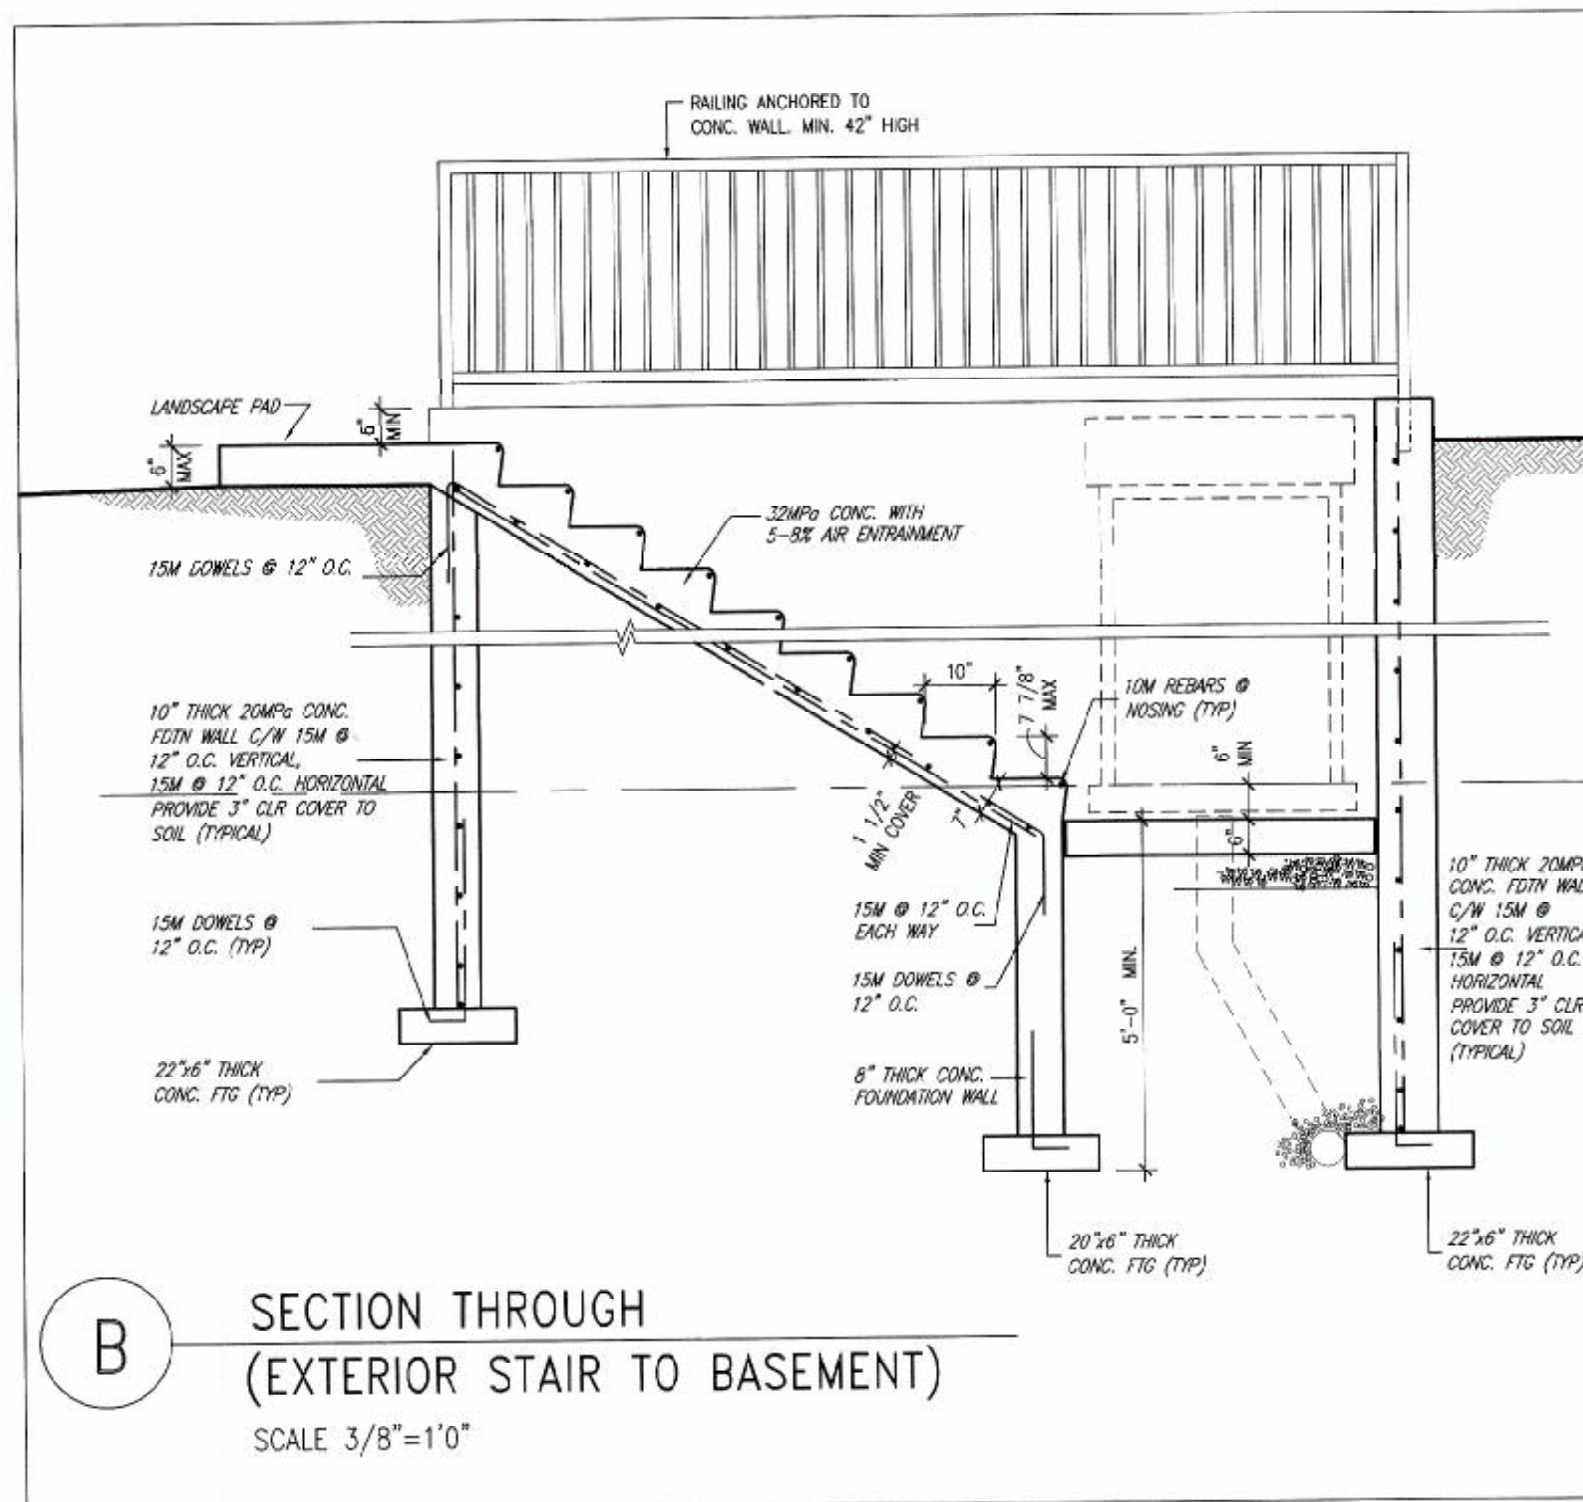


AREA CALCULATIONS	ELEV. A
GROUND FLOOR AREA	2130 SF
SECOND FLOOR AREA	2013 SF
SUBTOTAL	4143 SF
DEDUCT ALL OPEN AREAS	5 SF
TOTAL NET AREA	4138 SF (384.43 m ²)
FINISHED BSMT AREA	0 SF
COVERAGE	2830 SF
N/OUT PORCH	(232.91 m ²)
COVERAGE	2948 SF (273.88 m ²)
W/ PORCH	

NOTE: SPACE ALL FLOOR JOISTS @ 12" O.C. UNDER ALL CERAMIC TILE AREAS.

NOTE: ALL LVL'S SUPPORTING FLOOR LOADS ARE TO BE SPECIFIED BY FLOOR TRUSS MANUFACTURERS.

NOTE: FLOOR FRAMING INFO REFER TO SHOP DRAWINGS FOR ALL TRUSS-JOIST INFORMATION AND DETAILS, UNLESS OTHERWISE NOTED.

NOTE: J.L. PROVIDE SOLID BLOCKING @ 24" O.C. WHERE FLOOR JOISTS ARE PARALLEL TO FOUNDATION WALL (TYP.)

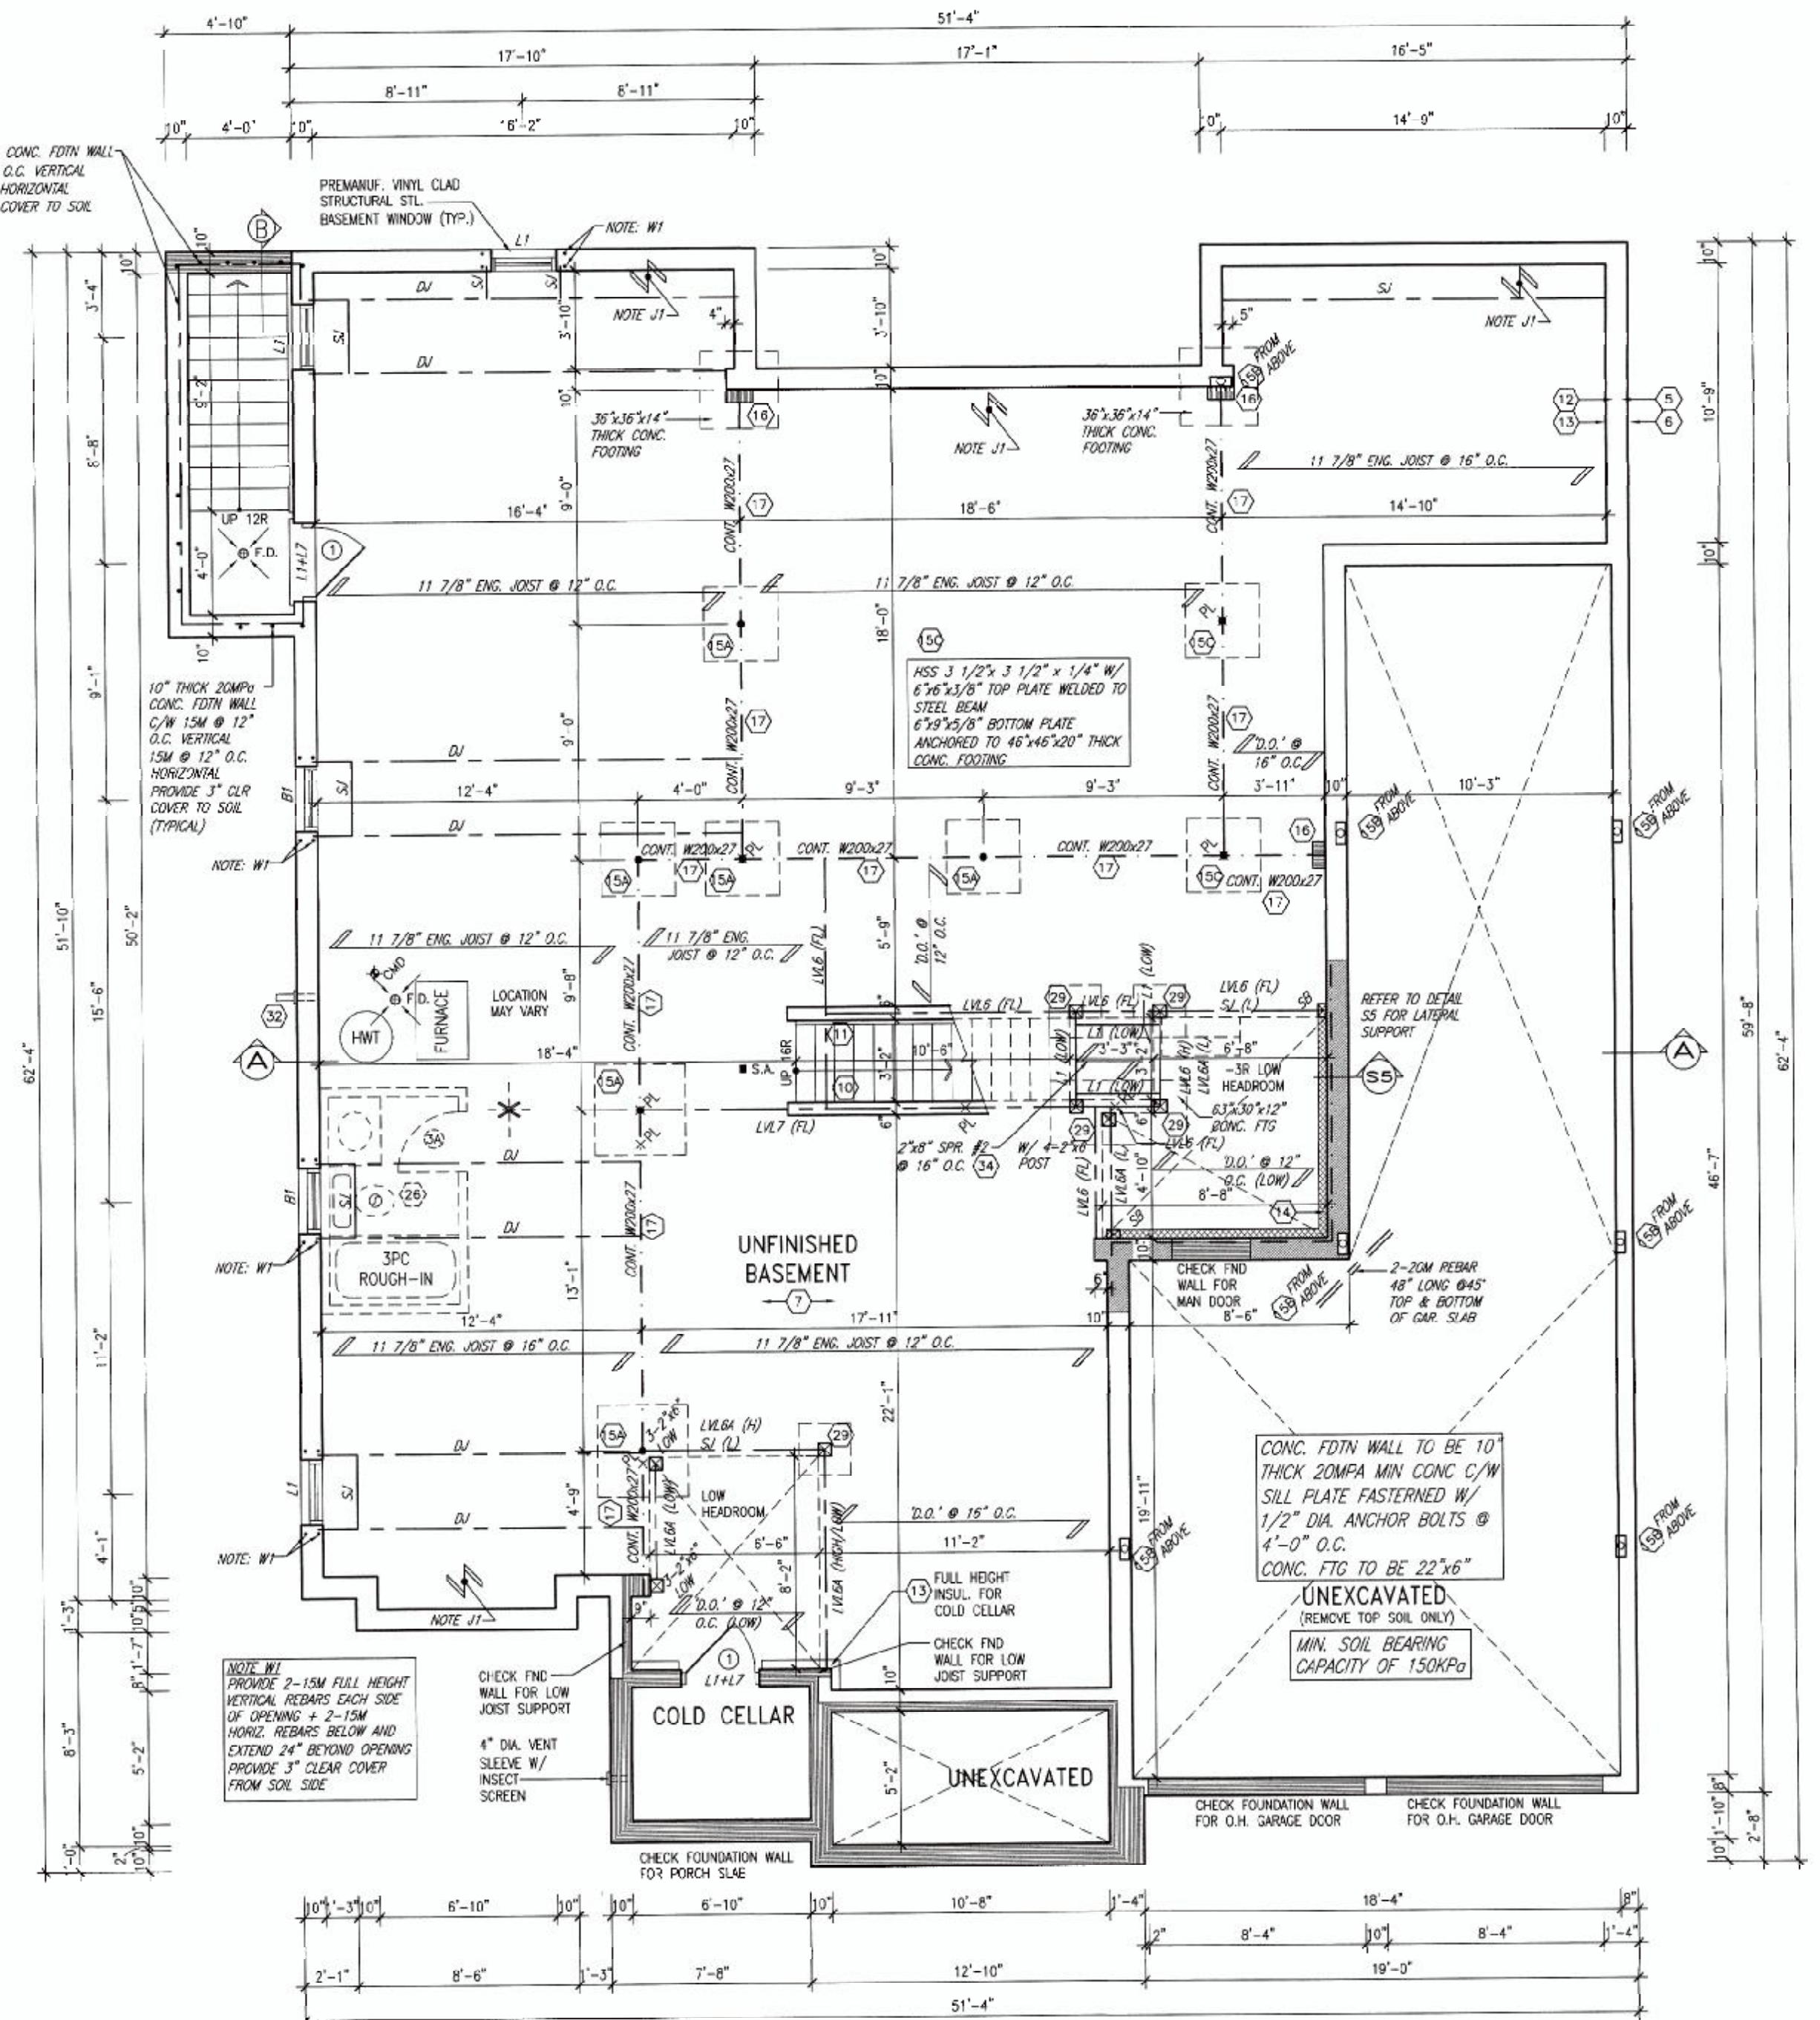



1	ISSUED FOR CLIENT REVIEW	SEP 21-16	BN	
2	REVISED AS PER ENG'S COMMENTS	MAY 12-17	CL	
3	REVISED GROUND FLOOR TO 8' HEIGHT	APR 21-17	SB	
4	REVISED AS PER ENG'S COMMENTS	NOV 28-16	RC	
5	REVISED AS PER ENG'S COMMENTS	MAY 19-17	RC	
6	REV. FOR LOT 126	MAY 12-17	CL	
7				
8				
9				



BAYVIEW WELLINGTON		S60-2	
GREEN VALLEY ESTATES		ROTHCHILD 2	
BRADFORD, ON.		project no. 13045	
DATE: SEPT. 2016		drawing no. 1	
DRAWN BY: RD/BN		SCALE: 3/16" = 1'-0"	
CHECKED BY: [Signature]		13045-S60-2-LOT 126	
PROJECTED BY: [Signature]		DATE: May 19, 2017 - 3:29 PM	

All drawings, specifications, notes, documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.

ARCHITECTURAL REVIEW & APPROVAL
JUN 12 2017
John G. Williams Limited, Architect

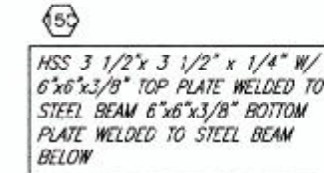

GROUND FLOOR PLAN 'A'

NOTE: ALL LVL'S SUPPORTING FLOOR LOADS ARE TO BE SPECIFIED BY FLOOR TRUSS MANUFACTURER.

5	REVISYED AS PER ENG'S COMMENTS	MAY 9-17	RC	25
6	REVISED FOR LOT 122	MAY 2-17	CL	
7	REVISED GROUND FLOOR TO 9' HEIGHT	APR 21-17	NS	426
8	REVISYED AS PER ENG'S COMMENTS	NOV 28-16	RC	
9	ISSUED FOR CLIENT REVIEW	SEP 21-16	SW	

The undersigned has reviewed and taken responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.

Registration Information

Wellington Ion-Baptiste *Wellington Ion-Baptiste* 25
 Designer *Designer*

Qualification Information

YAS Design Inc. 426
 Designer


I warrant that all dimensions on the job and record drawings are in accordance to the Engineer before proceeding with the work. All drawings are the property of the Designer and shall remain the property of the Designer which must be returned at the completion of the project.



drawn by	checked by	scale	file name
BD.BIM	-	3/16" = 1'-0"	13045-S60-2-LOT 126

10. American and Foreign related documents and notes on the overall conduct of the POW program, 1945-1946, 1947-1948, 1949-1950, 1951-1952, 1953-1954, 1955-1956, 1957-1958, 1959-1960, 1961-1962, 1963-1964, 1965-1966, 1967-1968, 1969-1970, 1971-1972, 1973-1974, 1975-1976, 1977-1978, 1979-1980, 1981-1982, 1983-1984, 1985-1986, 1987-1988, 1989-1990, 1991-1992, 1993-1994, 1995-1996, 1997-1998, 1999-2000, 2001-2002, 2003-2004, 2005-2006, 2007-2008, 2009-2010, 2011-2012, 2013-2014, 2015-2016, 2017-2018, 2019-2020, 2021-2022, 2023-2024, 2025-2026, 2027-2028, 2029-2030, 2031-2032, 2033-2034, 2035-2036, 2037-2038, 2039-2040, 2041-2042, 2043-2044, 2045-2046, 2047-2048, 2049-2050, 2051-2052, 2053-2054, 2055-2056, 2057-2058, 2059-2060, 2061-2062, 2063-2064, 2065-2066, 2067-2068, 2069-2070, 2071-2072, 2073-2074, 2075-2076, 2077-2078, 2079-2080, 2081-2082, 2083-2084, 2085-2086, 2087-2088, 2089-2090, 2091-2092, 2093-2094, 2095-2096, 2097-2098, 2099-2100, 2101-2102, 2103-2104, 2105-2106, 2107-2108, 2109-2110, 2111-2112, 2113-2114, 2115-2116, 2117-2118, 2119-2120, 2121-2122, 2123-2124, 2125-2126, 2127-2128, 2129-2130, 2131-2132, 2133-2134, 2135-2136, 2137-2138, 2139-2140, 2141-2142, 2143-2144, 2145-2146, 2147-2148, 2149-2150, 2151-2152, 2153-2154, 2155-2156, 2157-2158, 2159-2160, 2161-2162, 2163-2164, 2165-2166, 2167-2168, 2169-2170, 2171-2172, 2173-2174, 2175-2176, 2177-2178, 2179-2180, 2181-2182, 2183-2184, 2185-2186, 2187-2188, 2189-2190, 2191-2192, 2193-2194, 2195-2196, 2197-2198, 2199-2200, 2201-2202, 2203-2204, 2205-2206, 2207-2208, 2209-2210, 2211-2212, 2213-2214, 2215-2216, 2217-2218, 2219-2220, 2221-2222, 2223-2224, 2225-2226, 2227-2228, 2229-2230, 2231-2232, 2233-2234, 2235-2236, 2237-2238, 2239-2240, 2241-2242, 2243-2244, 2245-2246, 2247-2248, 2249-2250, 2251-2252, 2253-2254, 2255-2256, 2257-2258, 2259-2260, 2261-2262, 2263-2264, 2265-2266, 2267-2268, 2269-2270, 2271-2272, 2273-2274, 2275-2276, 2277-2278, 2279-2280, 2281-2282, 2283-2284, 2285-2286, 2287-2288, 2289-2290, 2291-2292, 2293-2294, 2295-2296, 2297-2298, 2299-2300, 2301-2302, 2303-2304, 2305-2306, 2307-2308, 2309-2310, 2311-2312, 2313-2314, 2315-2316, 2317-2318, 2319-2320, 2321-2322, 2323-2324, 2325-2326, 2327-2328, 2329-2330, 2331-2332, 2333-2334, 2335-2336, 2337-2338, 2339-2340, 2341-2342, 2343-2344, 2345-2346, 2347-2348, 2349-2350, 2351-2352, 2353-2354, 2355-2356, 2357-2358, 2359-2360, 2361-2362, 2363-2364, 2365-2366, 2367-2368, 2369-2370, 2371-2372, 2373-2374, 2375-2376, 2377-2378, 2379-2380, 2381-2382, 2383-2384, 2385-2386, 2387-2388, 2389-2390, 2391-2392, 2393-2394, 2395-2396, 2397-2398, 2399-2400, 2401-2402, 2403-2404, 2405-2406, 2407-2408, 2409-2410, 2411-2412, 2413-2414, 2415-2416, 2417-2418, 2419-2420, 2421-2422, 2423-2424, 2425-2426, 2427-2428, 2429-2430, 2431-2432, 2433-2434, 2435-2436, 2437-2438, 2439-2440, 2441-2442, 2443-2444, 2445-2446, 2447-2448, 2449-2450, 2451-2452, 2453-2454, 2455-2456, 2457-2458, 2459-2460, 2461-2462, 2463-2464, 2465-2466, 2467-2468, 2469-2470, 2471-2472, 2473-2474, 2475-2476, 2477-2478, 2479-2480, 2481-2482, 2483-2484, 2485-2486, 2487-2488, 2489-2490, 2491-2492, 2493-2494, 2495-2496, 2497-2498, 2499-2500, 2501-2502, 2503-2504, 2505-2506, 2507-2508, 2509-2510, 2511-2512, 2513-2514, 2515-2516, 2517-2518, 2519-2520, 2521-2522, 2523-2524, 2525-2526, 2527-2528, 2529-2530, 2531-2532, 2533-2534, 2535-2536, 2537-2538, 2539-2540, 2541-2542, 2543-2544, 2545-2546, 2547-2548, 2549-2550, 2551-2552, 2553-2554, 2555-2556, 2557-2558, 2559-2560, 2561-2562, 2563-2564, 2565-2566, 2567-2568, 2569-2570, 2571-2572, 2573-2574, 2575-2576, 2577-2578, 2579-2580, 2581-2582, 2583-2584, 2585-2586, 2587-2588, 2589-2590, 2591-2592, 2593-2594, 2595-2596, 2597-2598, 2599-2600, 2601-2602, 2603-2604, 2605-2606, 2607-2608, 2609-2610, 2611-2612, 2613-2614, 2615-2616, 2617-2618, 2619-2620, 2621-2622, 2623-2624, 2625-2626, 2627-2628, 2629-2630, 2631-2632, 2633-2634, 2635-2636, 2637-2638, 2639-2640, 2641-2642, 2643-2644, 2645-2646, 2647-2648, 2649-2650, 2651-2652, 2653-2654, 2655-2656, 2657-2658, 2659-2660, 2661-2662, 2663-2664, 2665-2666, 2667-2668, 2669-2670, 2671-2672, 2673-2674, 2675-2676, 2677-2678, 2679-2680, 2681-2682, 2683-2684, 2685

ARCHITECTURAL REVIEW & APPROVAL
JUN 12 2017
John C. Williams Limited, Architect

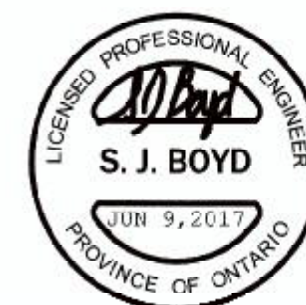


LOT 126

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Town of BRADFORD / WEST GUILDFORD.

ARCHITECTURAL DESIGN
JUN 12 2017
John G. Williams, Architect

UNINSULATED OPENINGS (PER CBC, SB-12.2.1.1.(7))			
ENERGY EFFICIENCY - CBC SB12			
ELEVATION	WALL AREA S.F.	OPENING S.F.	PERCENTAGE
FRONT	1060 S.F.	194 S.F.	18.30 %
LEFT SIDE	1253 S.F.	120 S.F.	9.58 %
RIGHT SIDE	1265 S.F.	35 S.F.	2.77 %
REAR	1008 S.F.	254 S.F.	25.20 %
ELEV 1B	85 S.F.	25 S.F.	29.41 %
ELEV 2B	85 S.F.	0.00 S.F.	0.00 %
TOTAL SQ. FT.	4756.00 S.F.	628.00 S.F.	13.20 %
TOTAL SQ. M.	441.84 S.M.	58.34 S.M.	13.20 %

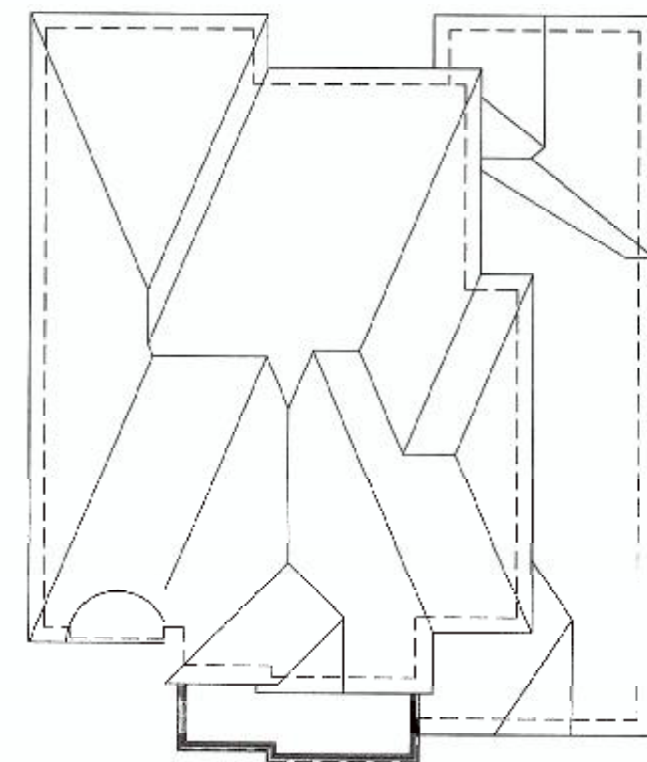

FRONT ELEVATION 'A'

NOTE FOR EXTERIOR RAILING
32" HIGH WHERE DISTANCE FROM PORCH TO FINISHED GRADE IS LESS THAN 2'-0".
36" HIGH WHERE DISTANCE EXCEEDS 2'-0".
42" HIGH RAILING IS REQUIRED WHERE DISTANCE EXCEEDS 5'-11".



LOT 126

VA3 DESIGN 3304 Wilson Avenue Toronto, ON M3J 1S8 416.630.2295 / 416.630.4782 va3design.com		BAYVIEW WELLINGTON GREEN VALLEY ESTATES BRADFORD, ON		S60-2 ROTHCHILD 2 project no. 13045 drawing no. 4	
revision 1 ISSUED FOR CLIENT REVIEW 2 REVISED AS PER ENG'S COMMENTS 3 REVISED GROUND FLOOR TO 6' HEIGHT 4 REV. FOR LOT 126 5 REVISED AS PER ENG'S COMMENTS		date SEP 21-16 MAY 12-17 MAY 12-17 APR 21-17 NOV 28-16		checked by JCB 3/16" = 1'-0"	
description no. description		date by		file name 13045-S60-2-LOT 126	

All drawings, specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.

seamless snuffboxes, painted tinware and dishes are the beautiful rewards of V&S FURN. Recollection of this reward is what we in and in itself, embodied - what WE DESERVE - with some...


It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. This Control Archival is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Town of BRADFORD / WEST GUILDFORD.

JUN 12/2017

John G. Williams, Architect

REFER TO FRONT ELEVATION FOR TYPICAL NOTES.

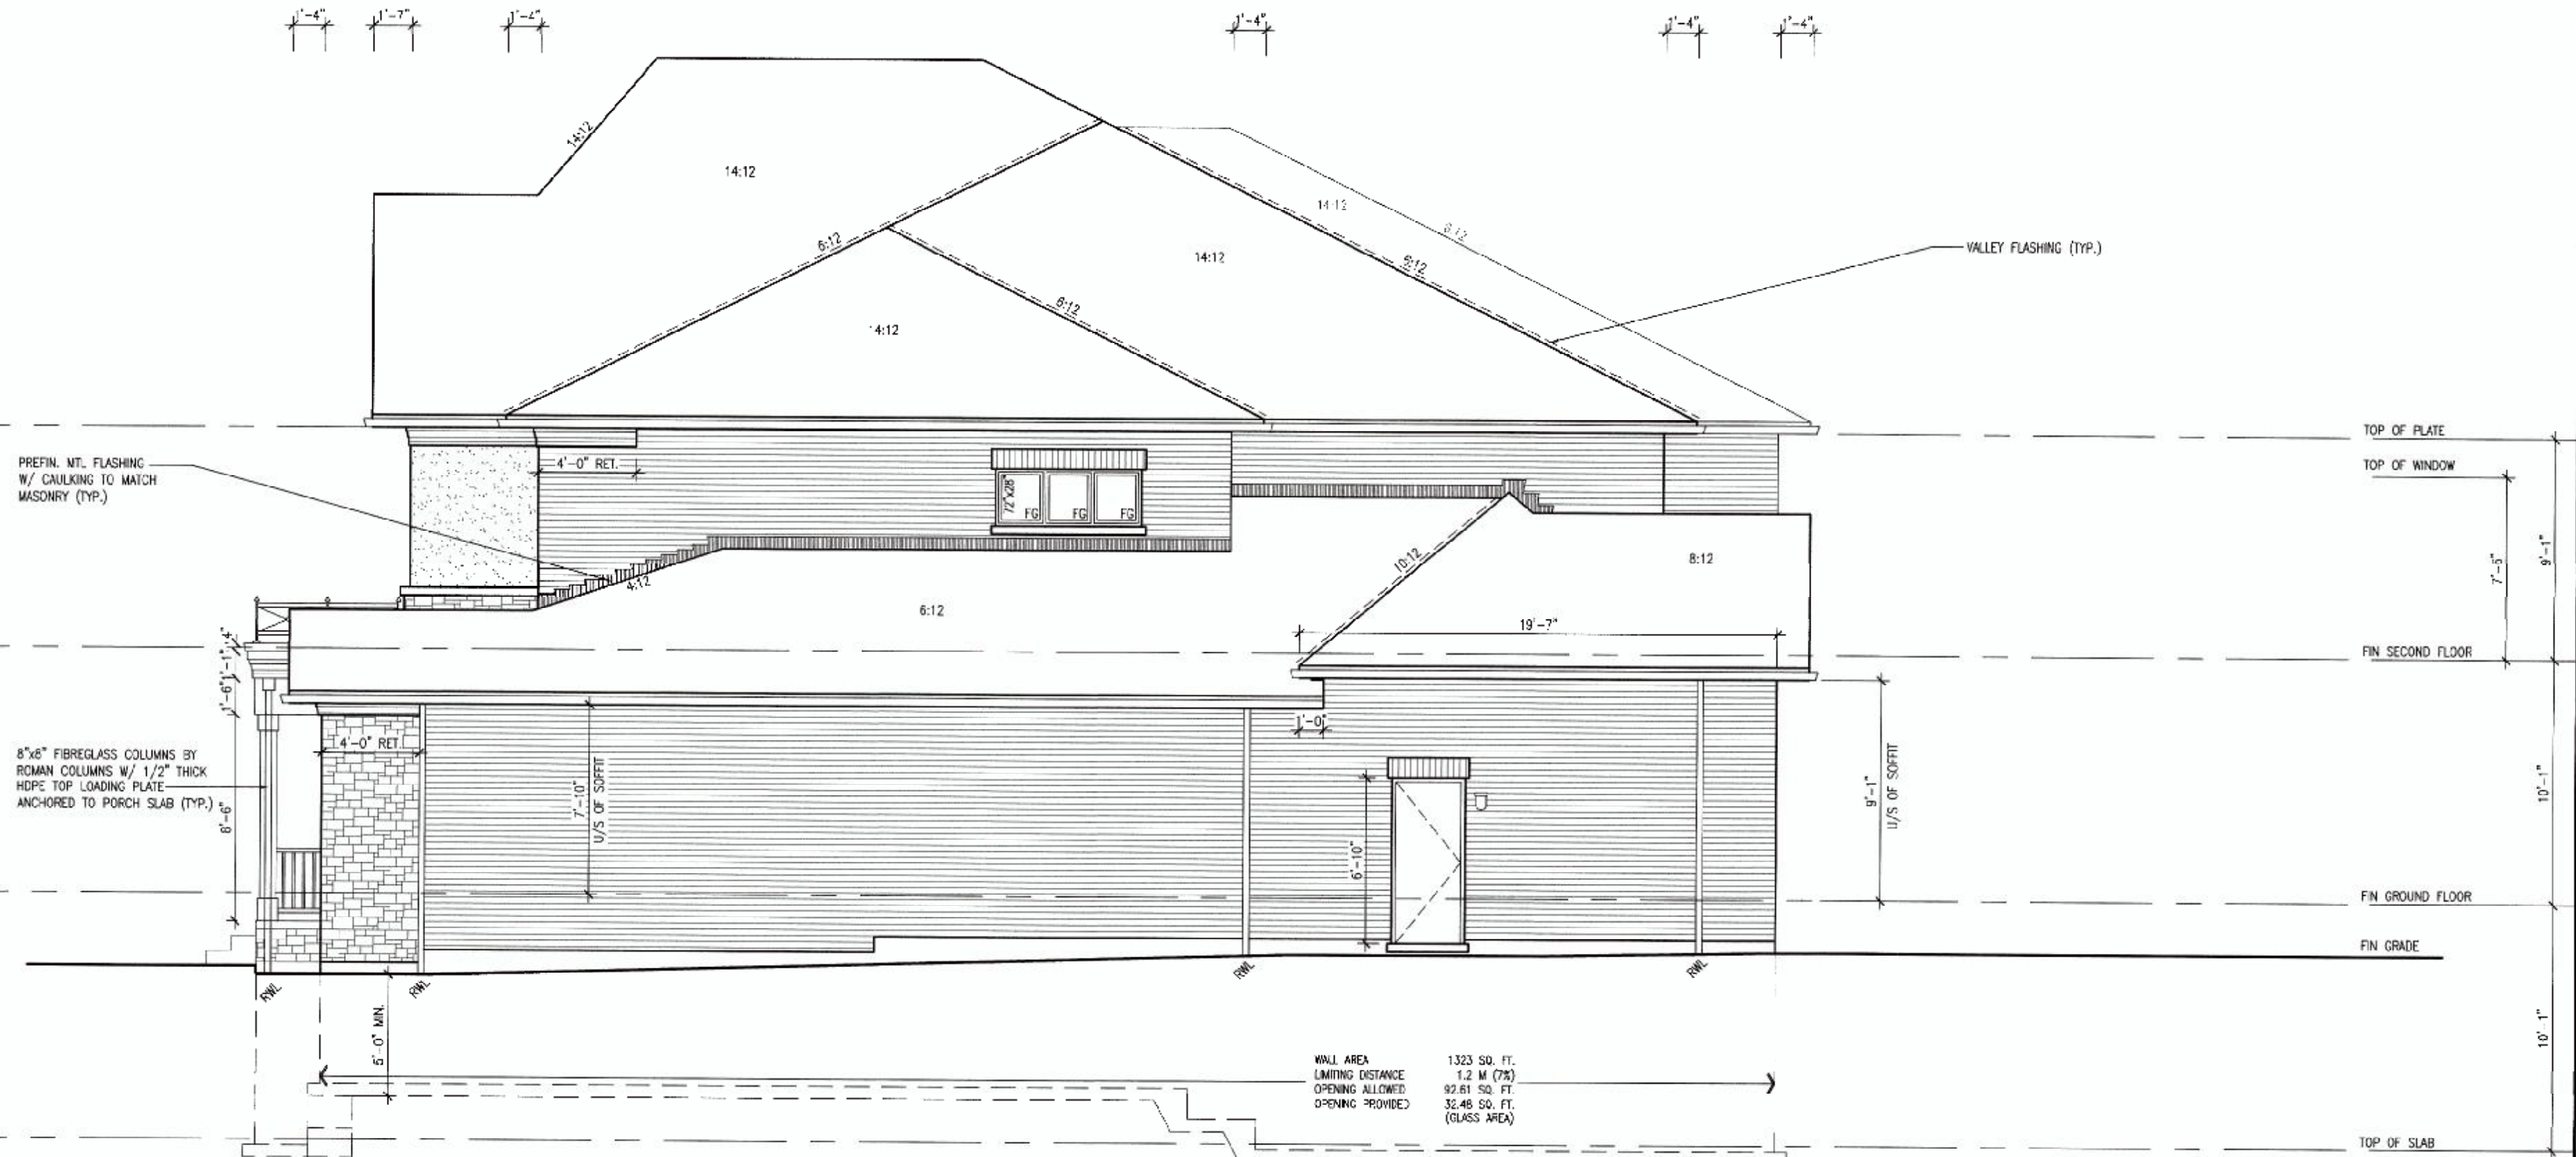

RIGHT SIDE ELEVATION 'A'



LOT 126

9	-	-	-	-	-	The applicant has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.
5	REVISED AS PER ENG'S COMMENTS	MAY 19-17	RC	Wellington Jiro-Bagplate	25591	 3004 Wilson Avenue Toronto, ON M3H 1S8 Tel: 416.630.2255 F: 416.830.4782 v&a.design.com
4	REV. FOR LOT 126	MAY 12-17	CL	regulation information	42656	
3	REVISED GROUND FLOOR TO 9' HEIGHT	APR 21-17	SB			
2	REVISED AS PER ENG'S COMMENTS	NOV 28-16	RC			
1	ISSUED FOR CLIENT REVIEW	SEP 21-16	EM			
no description			date by			

project name		municipality		project no.
GREEN VALLEY ESTATES		BRADFORD, ON.		13045
date	RIGHT SIDE ELEVATION 'A'			drawing no.
SEPT. 2016				6
drawn by	checked by	scale	date	revision
RD-BM	H.VANHOVE	5/16"	1"-0"	13045-560-2-L0T 126
RD-BM - H.VANHOVE (MORNING) 2015/09/14 13045-560-2-L0T 126A - F - May 2017 - 328 PM				

All drawings, specifications, related documents and design are the copyright property of V&A DESIGN. Reproduction of this drawing in whole or in part is strictly prohibited without V&A DESIGN's written permission.


This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Town of BRADFORD, VERMONT. JAGLE LAMBERT

ARCHITECTURAL APPROVAL

JUN 12 2017

John G. Williams Limited, Architect

REFER TO FRONT ELEVATION FOR
TYPICAL NOTES.

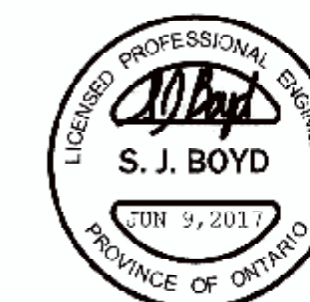

LOT 126


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40	41	42	43	44	45	46	47	48	49	50	51	52	53	54	55	56	57	58	59	60	61	62	63	64	65	66	67	68	69	70	71	72	73	74	75	76	77	78	79	80	81	82	83	84	85	86	87	88	89	90	91	92	93	94	95	96	97	98	99	100
										The undersigned has reviewed and taken responsibility for this design and has the qualifications as recited in the requirements set out in the project Bidding Code to be a Designer. qualification information Wellington Jno-Baptista <i>Jno-Baptista</i> 25551 name BCB experience information 42356 VAS DESIGN INC.										VAS DESIGN 3004 Willow Avenue Toronto, ON M4H 1S6 1-416-630-2295 / 416-630-4782										S60-2 ROTHCHILD 2																																																																					
1. REVISED AS PER ENO'S COMMENTS MAY 19-17 RCL										2. REV. FOR LOT 126 MAY 12-17 CL										3. REVISED FLOOR TO 9' HEIGHT APR 21-17 SB										4. REVISED AS PER ENO'S COMMENTS NOV 28-16 RCL										5. ISSUED FOR CLIENT REVIEW SEP 21-16 SB																																																											
										6. APPROVED WITH NO DISCREPANCIES ON THE JOB AND REPORT OF DISCREPANCY TO THE DESIGNER LATER PROCEEDING WITH THE WORK. ALL DISCREPANCIES ON THE JOB AND REPORT OF DISCREPANCY TO THE DESIGNER WHICH MUST BE RETURNED AT THE COMPLETION OF THE WORK. SEP 21-16 SB																																																																																									
																														project name GREEN VALLEY ESTATES BRADFORD, ON. revisionally project 1304										start date Sep. 2015 REAR ELEVATION "A" drawing no. 7																																																											
																				drawn by BCB checked by guide 3/16" = 1'-0" lot name 1304S-590-2 LOT 126										U.S. CUSTOMER'S PROJECT NO. 1304S-590-2 LOT 126																																																																					

All drawings specifications, related documents and design are the copyright property of JAG DESIGN. Reproduction of this property in whole or in part is strictly prohibited without JAG DESIGN's written permission.

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lot) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Town of BRADFORD / WEST GWILLIMBURY.

REFER TO FRONT ELEVATION FOR TYPICAL NOTES.

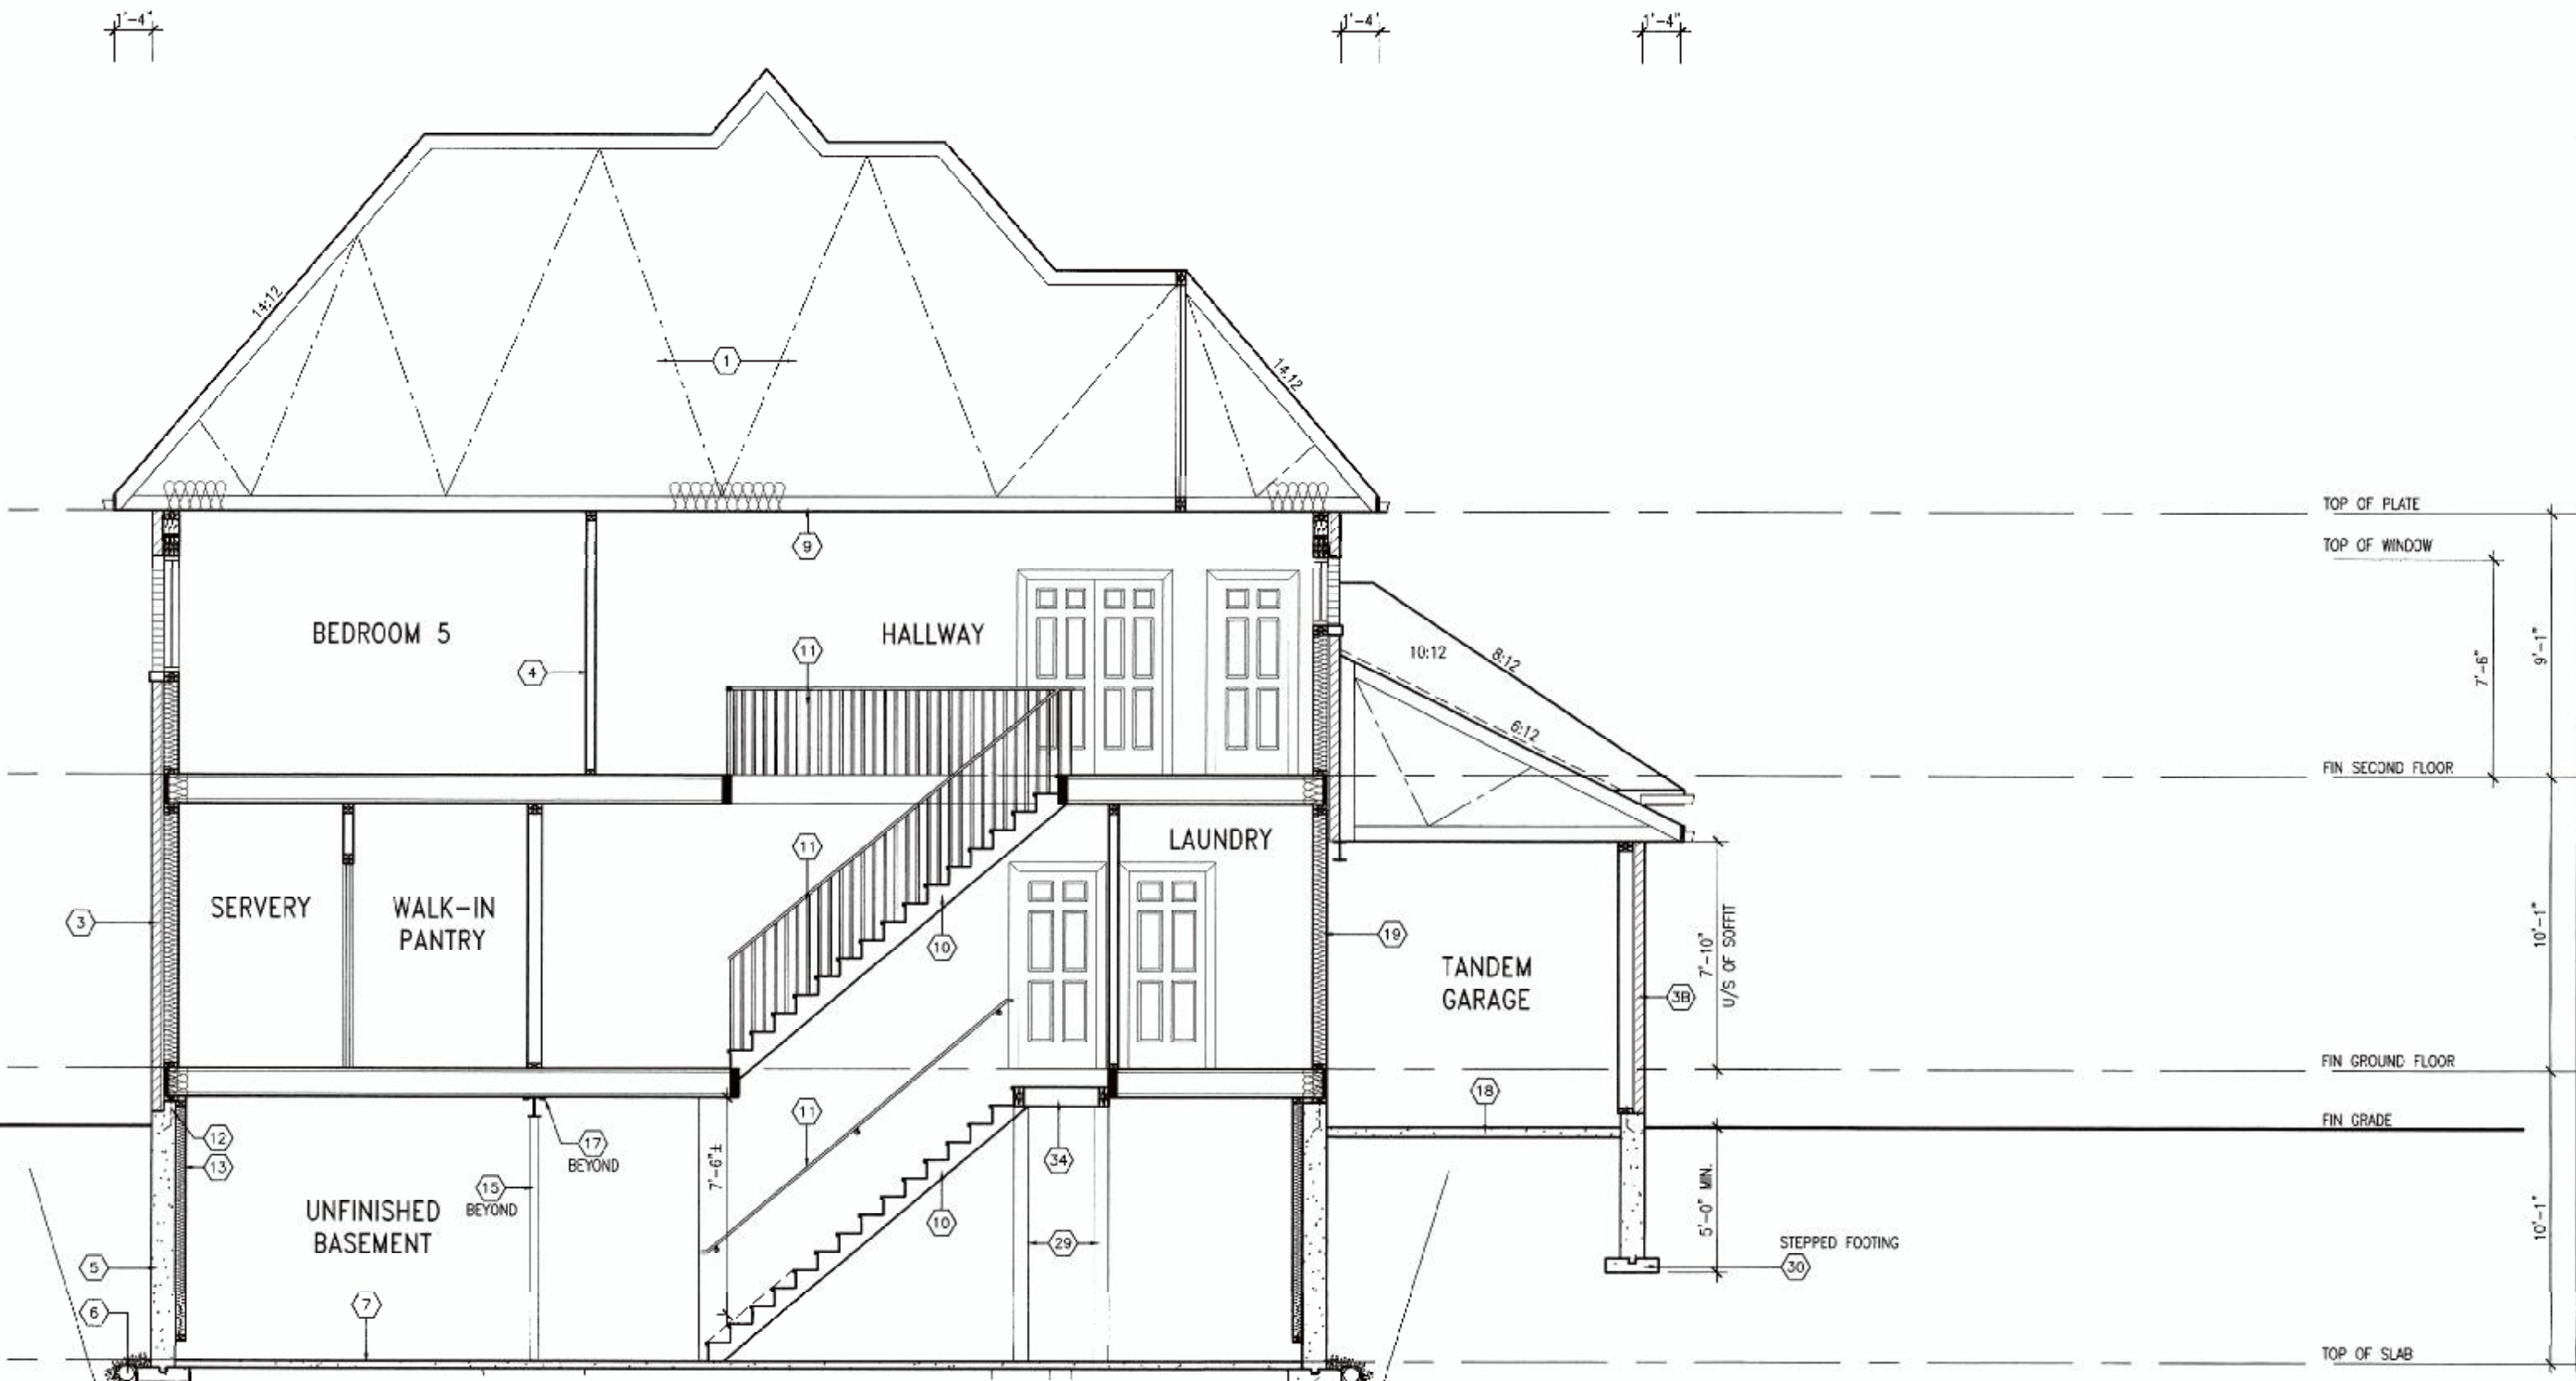

CROSS SECTION 'A-A'



LOT 126

9. - 8. - 7. - 6. - 5. REVISED AS PER ENG'S COMMENTS MAY 19-17 RC 4. REV. FOR LOT 126 MAY 12-17 CL 3. REVISED GARAGE FLOOR TO 3' HEIGHT APR 21-17 SB 2. REVISED AS PER ENG'S COMMENTS NOV 28-16 RC 1. ISSUED FOR CLIENT REVIEW SEP 21-15 BW	The undersigned has reviewed and taken responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. Wellington Jan-Baptiste 25591 name registration information VAB Design Inc. 42858 Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be retained at the completion of the work. Drawings are not to be copied.	VAB DESIGN 300A Wilson Avenue Toronto, ON M3H 1S8 T 416.630.2255 F 416.630.4782 vabdesign.com	BAYVIEW WELLINGTON Project name: GREEN VALLEY ESTATES Municipality: BRADFORD, ON. Date: SEPT. 2016 Drawn by: BB/BIM Scale: 3/16" = 1'-0"	S60-2 ROTHCHILD 2 Project no: 13045 Drawing no: 8 Title: CROSS SECTION 'A-A'
--	---	---	--	--

All drawings, specifications, related documents and designs are the copyright property of VAB DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VAB DESIGN's written permission.

CONSTRUCTION NOTES (Unless otherwise noted)

ALL CONSTRUCTION TO ADHERE TO THESE PLANS AND SPECIFICATIONS AND TO CONFORM TO THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE CODES AND AUTHORITIES HAVING JURISDICTION. THESE REQUIREMENTS ARE TO BE TAKEN AS MINIMUM SPECIFICATIONS. ONT. REG. 332/12-2012 OBC

1. ROOF CONSTRUCTION

NO.210 (10.25kg/m²) ASPHALT SHINGLES, 15mm (3/8") PLYWOOD SHEATHING WITH 1" CLIPS, APPROX. WOOD TRUSSES @ 600mm (24") O.C. MAX. APPROVED EAVES PROTECTION TO EXTEND 500mm (3'-0") FROM EDGE OF ROOF AND MIN. 300mm (12") BEYOND INNER FACE OF EXTERIOR WALL. (EAVES PROTECTION NOT REQ'D FOR ROOF SLOPES 6:12 OR GREATER) 38x89 (2"x4") TRUSS BRACING @ 1830mm (6'-0") O.C. AT BOTTOM CHORD. FRESH ALUM. ENASTROUGH, FASODA, FML & KENIED SURFILL. PROVIDE ICE & WATER SHIELD TO ALL ROOF/WALL SURFACES SUSCEPTIBLE TO ICE DAMMING. ROOF SHEATHING TO BE FASTENED 15c (6") c/c ALONG EDGES & INTERMEDIATE SUPPORTS WHEN TRUSSES SPACED GREATER THAN 405 (16"). ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH MIN. 25% AT EAVES & MIN. 25% AT RIDGE (OBC 9.10.1.2).

2. FRAME WALL CONSTRUCTION (2"x6") (SE-12-TABLE 2.1.1.2.A)

SIDING AS PER ELEV. 19x38 (1"x2") VERTICAL WOOD FURRING, CONTIN. SHEATHING MEMBRANE, 9.5mm (3/8") EXT. TYPE SHEATHING, 38x140 (2"x6") STUDS @ 400mm (16") O.C. INSULATION AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm (1/2") INT. DRYWALL FINISH. SIDING TO BE MIN. 200mm (8") ABOVE FINISH GRADE. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION.

2A. FRAME WALL CONSTRUCTION (2"x6") (R28)

SIDING AS PER ELEV. 19x38 (1"x2") VERTICAL WOOD FURRING, CONTIN. SHEATHING MEMBRANE, 20mm (3/4") EXTER. STRUCTURAL INSULATED SHEATHING RS 0.7 (R4) BY 80" OR EQUAL, 38x140 (2"x6") STUDS @ 400mm (16") O.C. RSI 4.23 (R24) INSUL. AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm (1/2") INT. DRYWALL FINISH. SIDING TO BE MIN. 200mm (8") ABOVE FINISH GRADE.

2B. FRAME WALL CONSTRUCTION (2"x4") - GARAGE WALLS

SIDING AS PER ELEV. 19x38 (1"x2") VERTICAL WOOD FURRING, CONTIN. SHEATHING MEMBRANE, 9.5mm (3/8") EXT. TYPE SHEATHING, 38x89 (2"x4") STUDS @ 400mm (16") O.C. MAX. HEIGHT 3000mm (9'-10"). WITH APPR. DIAGONAL WALL BRACING. SIDING TO BE MIN. 200mm (8") ABOVE FINISH GRADE.

2C. RESERVED

2D. STUCCO WALL CONSTRUCTION (2"x4") - GARAGE WALLS

STUCCO CLADDING SYSTEM CONFORMING TO O.B.C. 9.27.1.1.(2) & 9.28 THAT EMPLOY A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 25mm (1") MIN. EXPANDED OR EXTRUDED RIGID POLYSTYRENE OR APPROVED AIR/MOISTURE BARRIER ON 13mm (1/2") EXT. TYPE SHEATHING ON 38x89 (2"x4") STUDS @ 400 (16") O.C. STUCCO TO BE MIN. 200 (8") ABOVE FINISH GRADE.

2E. WALLS ADJACENT TO ATTIC SPACE - NO CLADDING

9.5mm (3/8") EXT. TYPE SHEATHING, 38x140 (2"x6") STUDS @ 400mm (16") O.C. INSULATION AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm (1/2") INTERIOR DRYWALL FINISH. MID-HEIGHT BLOCKING REQ'D IF NO SHEATHING APPLIED. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION.

3. BRICK VENEER CONSTRUCTION (2"x6")

90mm (4") FACE BRICK, 25mm (1") AIR SPACE, 22x180x176mm (7/8"x7"x0.03") GALV. METAL TIES @ 400mm (16") O.C. HORIZONTAL 600mm (24") O.C. VERTICAL APPROVED SHEATHING PAPER, 9.5mm (3/8") EXT. TYPE SHEATHING, 38x140 (2"x6") STUDS @ 400mm (16") O.C. INSULATION AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm (1/2") INTERIOR DRYWALL FINISH. PROVIDE WEEP HOLES @ 800mm (32") O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION. BRICK TO BE MIN. 150mm (6") ABOVE FINISH GRADE.

3A. BRICK VENEER CONSTRUCTION (2"x6") (R28)

90mm (4") FACE BRICK, 25mm (1") AIR SPACE, 22x180x176mm (7/8"x7"x0.03") GALV. METAL TIES @ 400mm (16") O.C. HORIZONTAL 600mm (24") O.C. VERTICAL APPROVED SHEATHING PAPER, 28mm (1 1/8") EXT. TYPE SHEATHING, 38x140 (2"x6") STUDS @ 400mm (16") O.C. INSULATION AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm (1/2") INTERIOR DRYWALL FINISH. PROVIDE WEEP HOLES @ 800mm (32") O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER. BRICK TO BE MIN. 150mm (6") ABOVE FINISH GRADE.

3B. BRICK VENEER CONSTRUCTION (2"x4") - GARAGE WALLS

90mm (4") FACE BRICK, 25mm (1") AIR SPACE, 22x180x176mm (7/8"x7"x0.03") GALV. METAL TIES @ 400mm (16") O.C. HORIZONTAL 600mm (24") O.C. VERTICAL APPROVED SHEATHING PAPER, 9.5mm (3/8") EXT. TYPE SHEATHING, 38x89 (2"x4") STUDS @ 400mm (16") O.C. (MAX. HEIGHT 3000mm 9'-10") WITH APPR. DIAGONAL WALL BRACING. PROVIDE WEEP HOLES @ 800mm (32") O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER. BRICK TO BE MIN. 150mm (6") ABOVE FINISH GRADE.

3C. STUCCO WALL CONSTRUCTION (2"x6") (SB-12-TABLE 2.1.1.2.A)

STUCCO CLADDING SYSTEM CONFORMING TO O.B.C. 9.27.1.1.(2) & 9.28 THAT EMPLOY A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 25mm (1") MIN. EXPANDED OR EXTRUDED RIGID POLYSTYRENE OR APPROVED AIR/MOISTURE BARRIER ON 13mm (1/2") EXT. TYPE SHEATHING ON 38x140 (2"x6") STUDS @ 400mm (16") O.C. RSI 4.23 (R24) INSUL. & APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm (1/2") INTERIOR DRYWALL FINISH. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION. STUCCO TO BE MIN. 200 (8") ABOVE FINISH GRADE.

4. INTERIOR STUD PARTITIONS

FOR BEARING PARTITIONS 38x89 (2"x4") @ 400mm (16") O.C. FOR 2 STOREYS AND 300mm (12") O.C. FOR 3 STOREYS, NON-BEARING PARTITIONS 38x89 (2"x4") @ 500mm (24") O.C. PROVIDE 38x89 (2"x4") BOTTOM PLATE AND 2/38x89 (2"x4") TOP PLATE, 13mm (1/2") INT. DRYWALL, BOTH SIDES OF STUDS. PROVIDE 38x140 (2"x6") STUDS/PLATES WHERE NOTED.

5. FOUNDATION WALL/FOOTINGS: (9.15.3, 9.15.4, 9.13.2, 9.14.2, 1.2.2)

200mm (8") POURED CONC. FTN. WALL 15MPa (220ksi) WITH BITUMINOUS DAMPPROOFING AND DRAINAGE LAYER. DRAINAGE LAYER REQ'D WHEN BASEMENT INSUL. EXTENDS 900 (2'-11") BELOW FIN. GRADE. DRAINAGE LAYER IS NOT REQ'D WHEN FTN. WALL IS WATERPROOFED. MAXIMUM POUR HEIGHT 2350 (7'-10") ON 500x155 (20"x6") CONTINUOUS KEYED CONC. FTG. BRACE FTN. WALL PRIOR TO BACKFILLING. ALL FOOTINGS SHALL REST ON NATURAL UNDISTURBED SOIL OR COMPACTED ENGINEERED FILL WITH MIN. BEARING CAPACITY 150kPa (2.08 cfs) OR GREATER. IF SOIL BEARING DOES NOT MEET MINIMUM CAPACITY, ENGINEERED FOOTINGS ARE REQUIRED.

STORIES SUPPORTED W/ MASONRY VENEER W/ SILLING ONLY

1 20" WIDE x 6" DEEP 16" WIDE x 6" DEEP
2 20" WIDE x 6" DEEP 20" WIDE x 6" DEEP
3 20" WIDE x 6" DEEP 20" WIDE x 6" DEEP

SEE OBC 9.15.3.

-MAXIMUM FLOOR LIVE LOAD OF 2.4kPa (50psf) PER FLOOR, AND MAX. LENGTH OF SUPPORTED FLOOR JOISTS IS 4.5m (16'-1").
-REFER TO SOILS REPORT FOR SOIL CONDITIONS AND BEARING CAPACITY.

STRIP FOOTING SUPPORTING EXTERIOR WALLS (FOR W.O.B.)

-ASSUMING MASONRY VENEER CONSTRUCTION, MAX. FLOOR LIVE LOAD OF 2.4kPa (50psf) PER FLOOR, AND MAX. LENGTH OF SUPPORTED FLOOR JOISTS IS 4.5m (16'-1"). THE STRIP FOOTING SIZE IS AS FOLLOWS:

2 STOREY WITH WALK-OUT BASEMENT 545x175 (22"x7")

6. FOUNDATION DRAINAGE OBC 9.14.2 & 9.14.3

100mm (4") FOUNDATION DRAINAGE TILE 150mm (6") CRUSHED STONE OVER AND AROUND DRAINAGE TILES.

7. BASEMENT SLAB OBC 9.1.6 (1.10) 9.1.6.3 (1.1) 9.25.3.3 (1.5)

80mm (3") MIN. 25MPa (3600psi) CONC. SLAB ON 100mm (4") COARSE GRANULAR FILL, OR 200MPa (3000psi) CONC. WITH DAMPPROOFING BELOW SLAB. UNDER SLAB INSULATION PER SB-12. ALL JOINTS & PENETRATIONS TO BE CAULKED.

8. EXPOSED FLOOR TO EXTERIOR (SB-12-TABLE 2.1.1.2.A)

PROVIDE RSI 5.48 (R31) INSULATION, APPROVED VAPOUR BARRIER AND CONTINUOUS AIR BARRIER, FINISHED SOFT.

9. ATTIC INSULATION (SB-12-TABLE 2.1.1.2.A) (SB-12-1.1.1.7)

RSI 8.31 (R50) BLOWN IN ROOF INSULATION AND APPROVED VAPOUR BARRIER, 16mm (5/8") INT. DRYWALL FINISH OR APPROVED EQUAL. RSI 3.52 (R20) MIN. ABOVE INNER SURFACE OF EXTERIOR WALL.

10. ALL STAIRS/EXTERIOR STAIRS - OBC 9.8 -

UNIFORM RISE - 5mm (1/4") MAX BETWEEN ADJACENT TREADS OR 10mm (1/2") MAX BETWEEN TALLEST & SHORTEST RISE IN FLIGHT

MAX. RISE = 200 (7'-7/8")
MIN. RUN = 210 (6'-10")
MIN. TREAD = 230 (9'-1/4")
MAX. NOSING = 25 (1")
MIN. HEADROOM = 1950 (6'-5")
RAIL @ LANDING = 900 (2'-11")
RAIL @ STAIR = 865 (2'-10") TO 965 (3'-2")
MIN. STAIR WIDTH = 860 (2'-10")
MIN. RUN = 150 (6")
MIN. RISE = 200 (8")

11. HANDRAILS - OBC 9.8.7 -

FINISHED RAILING ON PICKETS SPACED MAXIMUM 100mm (4") BETWEEN PICKETS. CLEARANCE BETWEEN HANDRAIL AND SURFACE BEHIND IT TO BE 50 (2") MIN. HANDRAILS TO BE CONTINUOUS EXCEPT FOR NEWEL POST AT CHANGES OF DIRECTION.

INTERIOR GUARDS - OBC 9.8.8 -

INTERIOR GUARDS: 900mm (2'-11") MIN. HIGH EXTERIOR GUARDS - OBC 9.8.8

900mm (36") HIGH GUARD WHERE DISTANCE FROM PORCH TO FIN. GRADE IS LESS THAN 1800mm (7') 1000mm (42") HIGH GUARD IS REQUIRED WHERE DISTANCE EXCEEDS 1800mm (7').

12. SILL PLATE - OBC 9.23.7

38x89 (2"x4") SILL PLATE WITH 13mm (1/2") DIA. ANCHOR BOLTS 200mm (8") LONG, EMBEDDED MIN. 100mm (4") INTO CONC. @ 2400mm (7'-10") O.C. CAULKING OR 25 (1") MIN. MINERAL WOOL BETWEEN PLATE AND TOP OF FTN. WALL. USE NON-SHRINK GROUT TO LEVEL SILL PLATE WHEN REQUIRED.

13. BASEMENT INSULATION (SB-12-1.1.6) 9.25.3.3 (1.2) 9.25.3.3 (1.5)

FOUNDATION WALLS ENCLOSING HEATED SPACE SHALL BE INSULATED FROM THE INSIDE OF THE SUBFLOOR TO NOT MORE THAN 200mm (8") ABOVE THE FINISHED FLOOR & NO CLOSER THAN 50mm (2") OF THE BASEMENT SLAB. INSULATION TO HAVE APPROVED VAPOUR BARRIER, DAMPPROOF WITH BUILDING PAPER BETWEEN THE FOUNDATION WALL AND INSULATION UP TO GRADE LEVEL. NOTE: FULL HEIGHT INSULATION AT COLD CELLAR WALLS. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION. AIR BARRIER TO BE SEALED TO FTN. WALL WITH CAULKING.

14. BEARING STUD PARTITION

38x89 (2"x4") STUDS @ 400mm (16") O.C. 38x89 (2"x4") SILL PLATE ON DAMPPROOFING MATERIAL, 13mm (1/2") DIA. ANCHOR BOLTS 200mm (8") LONG, EMBEDDED MIN. 100mm (4") INTO CONC. @ 2400mm (7'-10") O.C. 100mm (4") HIGH CONC. CURB ON 350x155 (14"x6") CONC. FOOTING, AND HORIZ. BLOCKING AT MID-HEIGHT IF WALL IS UNFINISHED.

15. STEEL BASEMENT COLUMN (SEE OBC 9.15.3.3)

89mm (3-1/2") DIA. x 3.0mm (0.118) SINGLE WALL TUBE TYPE 2 ADJUSTABLE ST. COL. W/ MIN. CAPACITY OF 71.2kN (16,000lbs) AT A MAX. EXTENSION OF 231mm (7'-7 1/2") CONFORMING TO CAN/CSSB-7.2-94, AND WITH 150x150x5.5 (6"x6"x3/8") STL. PLATE TOP & BOTTOM, 870x870x11.4 (34"x34"x1/2") CONC. FOOTING ON UNDISTURBED SOIL OR ENGINEERED FILL CAPABLE OF SUSTAINING A PRESSURE OF 150 Kpa. MINIMUM AND AS PER SOILS REPORT.

15A. STEEL BASEMENT COLUMN (SEE OBC 9.15.3.3)

89mm (3-1/2") DIA. x 4.78mm (188) FIXED STL. COL. WITH 150x150x5.5 (6"x6"x3/8") STL. TOP & BOTTOM PLATE ON 1070x1070x46 (42"x42"x1 7/8") CONC. FOOTING ON UNDISTURBED SOIL OR ENGINEERED FILL CAPABLE OF SUSTAINING A PRESSURE OF 150 Kpa. MIN. AND AS PER SOILS REPORT.

15B. STEEL COLUMN

90mm (3-1/2") DIA. x 4.78mm (188) NON-ADJUSTABLE ST. COL. TO BE ON 150x150x5.5 (6"x6"x3/8") STL. TOP PLATE, & BOTTOM PLATE, BASE PLATE 120x120x46 (4 1/2"x4 1/2"x1 7/8") WITH 2-12mm DIA. x 300mm LONG x50mm HOOK ANCHORS (2-1/2"x12x2") FIELD WELD COL. TO BASE PLATE.

16. CONCRETE NIB / POCKET

BEAM POCKET OR 300x150 (12"x6") POURED CONC. NIB WALLS. MIN. BEARING 90mm (3-1/2")

17. 19x64 (1"x3") CONTINUOUS WOOD STRAPPING BOTH SIDES OF STEEL BEAM

18. GARAGE SLAB

100mm (4") 30MPa (4840psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT ON OPT. 100 (4") COARSE GRANULAR FILL WITH COMPACTED SUB-BASE OR COMPACTED NATIVE FILL. SLOPE TO FRONT.

19. GARAGE CEILINGS/INTERIOR WALLS

13mm (1/2") GYPSUM BOARD ON WALL AND CEILING BETWEEN BASEMENT AND GARAGE. ALL TRUSSES @ 1200mm (4'-0") O.C. VERTICALLY. FOR WALLS WITH HORZ. DISTANCES NOT EXCEEDING 2900mm (9'-6"), PROVIDE 38x140 (2"x6") STUDS @ 400 (16") O.C. WITH CONTINUOUS 2-38x140 (2"x6") TOP PLATES + 1-38x140 (1-2"x6") BOTTOM PLATE & MINIMUM OF 3-38x184 (3-2"x6") CONT. HEADER AT GRND. CEILING LEVEL. TOE-NAILLED & GULLED AT TOP, BOTTOM PLATES AND HEADERS.

20. DOOR AND FRAME GASPROOFED. DOOR EQUIPPED WITH SELF CLOSING DEVICE AND NO WEATHERSTRIPPING PER OBC 9.10.13.15.

21. EXTERIOR STEP

PRECAST CONCRETE STEP OR WOOD STEP WHERE NOT EXPOSED TO WEATHER. MAX. RISE 200mm (7'-7/8") MIN. TREAD 250mm (9'-1/2"). SEE OBC 9.8.9.2, 9.8.9.3 & 9.8.10.

22. DRYER EXHAUST (OBC-6.2.3.8.7) & 6.2.4.1.1

CAPPED DRYER EXHAUST VENTED TO EXTERIOR. (USE 100mm (4") DIA. SMOOTH WALL VENT PIPE)

23. INSULATED ATTIC ACCESS (OBC-9.19.2.1 & SB-12-1.1.1.7)

ATTIC ACCESS HATCH WITH MIN. DIMENSION OF 545x610mm (21 1/2"x24") & A MIN. AREA OF 0.32 SQ.M. (3.44 SQ.FT.) WITH WEATHERSTRIPPING. RSI 3.52 (R20) RIDGE INSUL. BACKING.

24. FIREPLACE CHIMNEYS (OBC 9.2.1)

TOP OF FIREPLACE CHIMNEY SHALL BE 915mm (3'-0") ABOVE THE HIGHEST POINT AT WHICH IT COMES IN CONTACT WITH THE ROOF AND 810mm (2'-0") ABOVE THE ROOF SURFACE WITHIN A HORIZ. DISTANCE OF 3050mm (10'-3") FROM THE CHIMNEY.

25. LINEN CLOSET

LINEN CLOSET, 4 SHELVES MIN. 350mm (14") DEEP.

26. MECHANICAL EXHAUST

MECHANICAL EXHAUST FAN, VENTED TO EXTERIOR AS REQUIRED BY OBC 9.13.3.5 & 9.13.3.10.

27. STEEL BEARING PLATE FOR MASONRY WALLS

260x280x12 (11"x11"x5/8") STL. PLATE FOR STL BEAMS AND 260x280x12 (11"x11"x1/2") STL. PLATE FOR WOOD BEAMS BEARING ON CONC. BLOCK PARTYWALL, ANCHORED TO 2-19mm (3/4") x 200mm (8") LONG GALV. ANCHORS WITHIN SOLID BLOCK COURSE. LEVEL WITH NON-SHRINK GROUT.

SOLID WOOD BEARING FOR WOOD STUD WALLS

SOLID BEARING TO BE AT LEAST AS WIDE AS THE SUPPORTED MEMBER. SOLID WOOD BEARING COMPRISED OF BUILT-UP WOOD STUDS TO BE CONSTRUCTED IN ACCORDANCE WITH OBC 9.17.4.2(2).

28. RESERVED

29. BEARING WOOD POST (BASEMENT) (OBC 9.17.4)

3-38x140 (3-2"x6") BUILT-UP POST ON METAL BASE SHOE ANCHORED TO CONC. WITH 12.7 DIA. BOLT, 610x610x300 (24"x24"x12") CONC. FOOTING.

30. STEPPED FOOTINGS OBC 9.15.3.9

MIN. HORIZ. STEP = 600mm (24")
MAX. VERT. STEP = 600mm (24")

31. SLAB ON GRADE

MIN. 100mm (4") CONCRETE SLAB ON GRADE ON 100mm (4") COARSE GRANULAR FILL, REINFORCED WITH 6x6-W2.9W2.9 MESH (PLACED) NEAR MID-DEPTH OF SLAB. CONC. STRENGTH 35 MPa (4840 psi) WITH 5-8% AIR ENTRAINMENT ON COMPACTED SUB-GRADE. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION UNDER SLAB.

32. DIRECT VENTING GAS FURNACE / H.W.T. VENT

DIRECT VENT FURNACE TERMINAL, MIN. 900mm (36") FROM A GAS REGULATOR MIN. 300mm (12") ABOVE FIN. GRADE. FROM ALL OPENINGS, EXHAUST AND INTAKE VENTS. HRY INTAKE TO BE A MIN. OF 1830mm (5'-0") FROM ALL EXHAUST TERMINALS. REFER TO GAS UTILIZATION CODE.

33. DIRECT VENTING GAS FIREPLACE VENT

DIRECT VENT GAS FIREPLACE. VENT TO BE A MINIMUM 300mm (12") FROM ANY OPENING AND ABOVE FIN. GRADE. REFER TO GAS UTILIZATION CODE.

34. SUBFLOOR, JOIST STRAPPING AND BRIDGING

6mm (5/8") 1" & 2" SUBFLOOR ON WOOD FLOOR JOISTS. FOR CERAMIC TILE APPLICATION (* SEE OBC 9.0.6.2.2) 9mm (1/4") PANEL TYPE UNDERLAY UNDER RESILIENT & PARQUET FLOORING. (* SEE OBC 9.0.2.4)

FLOOR JOISTS WITH SPANS OVER 2100mm (5'-11") TO BE BRIDGED WITH 38x38 (2"x2") CROSS BRACING OR SOLID BLOCKING @ 2100mm (6'-11") O.C. MAX. AND WHERE SPECIFIED BY JOIST TABLES A-1 OR A-2 STRAPPING SHALL BE 15x64 (1"x3") @ 2100mm (5'-11") O.C. UNLESS A PANEL TYPE CEILING FINISH IS APPLIED. (* SEE OBC 9.2.3.4.4)

35. EXPOSED BUILDING FACE (OBC 9.10.15 & SB-2-2.3.5(2))

EXTERIOR WALLS TO HAVE A FIRE RESISTANCE RATING OF NOT LESS THAN 45 min. WHERE LIMITING DISTANCE (LD) IS LESS THAN 1.2M (3'-11"). WHERE THE LD IS LESS THAN 600mm (1'-11") THE EXPOSING FACE SHALL BE CLAD IN NON-COMBUSTIBLE MATERIAL. SEE ELEVATIONS FOR ADDITIONAL NOTES. OFFENDING GARAGE WALLS INCLUDED.

36. COLD CELLAR PORCH SLAB (OBC 9.39)

FOR MAX. 2500mm (8'-2") PORCH DEPTH (SHORTEST DIM.), 125mm (5") 32MPa (4840psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT. REIN. WITH 10M BARS @ 200mm (7'-7/8") O.C. EACH WAY IN BOTTOM THIRD OF SLAB. MIN. 30mm (1 1/4") COVER. 600x600 (23 5/8"x23 5/8") 10M DOWELS @ 600mm (23 5/8") C.C., ANCHORED IN PERMETER FTN. WALLS. SLOPE SLAB MIN. 1.0% FROM HOUSE WALL. SLAB TO HAVE MIN. 75mm (3") BEARING ON FTN. WALLS. PROVIDE (7) UNTEL OVER CELLAR DOOR WITH 100mm (4") END BEARING.

37. BRICK CHECK

THE FTN. WALL SHALL NOT BE REDUCED TO LESS THAN 90mm (3-1/2") THICK TO A MAX. DEPTH OF 600mm (24") AND SHALL BE TIED TO THE FACING MATERIAL WITH METAL TIES SPACED 200mm (8") O.C. VERTICALLY AND 900mm (36") O.C. HORIZONTALLY. FILL SPACE BETWEEN WALL AND FACING SOLID WITH MORTAR.

38. CONVENTIONAL ROOF FRAMING (2.0kpa. SNOW LOAD)

38x140 (2"x6") RAFTERS @ 400mm (16") O.C. FOR MAX 11'-7" SPAN, 38x184 (2"x6") RIDGE BOARD, 38x89 (2"x4") COLLAR TIES AT MIDSPANS. CEILING JOISTS TO BE 38x89 (2"x4") @ 400mm (16") O.C. FOR MAX. 2830mm (9'-3") SPAN & 38x140 (2"x6") @ 400 (16") O.C. FOR MAX. 4450mm (14'-7") SPAN.

HANGERS FOR BUILT-UP ROOF TO BE 38x89 (2"x4") @ 600mm (24") O.C. WITH A 38x89 (2"x4") CENTRE POST TO THE TRUSS BELOW. LATERSLALLY BRACED @ 1800mm (6'-0") O.C. VERTICALLY.

39. TWO STOREY VOLUME SPACES

FOR A MAXIMUM 5490 mm (18'-0") HEIGHT AND MAXIMUM SUPPORTED ROOF TRUSS LENGTH OF 6.0m, PROVIDE 2-38x140 (2-2"x6") SPR.#2 CONTIN. STUDS @ 300mm (12") O.C. (TRIPLIE UP AT EVERY THIRD DOUBLE STUD FOR BRICK WALLS) C/W 9.5 (3/8") THICK EXT. PLYWOOD SHEATHING. PROVIDE SOLID WOOD BLOCKING BETWEEN WOOD STUDS @ 1200 mm (4'-0") O.C. VERTICALLY. FOR WALLS WITH HORZ. DISTANCES NOT EXCEEDING 2900 mm (9'-6"), PROVIDE 38x140 (2"x6") STUDS @ 400 (16") O.C. WITH CONTINUOUS 2-38x140 (2-2"x6") TOP PLATES + 1-38x140 (1-2"x6") BOTTOM PLATE & MINIMUM OF 3-38x184 (3-2"x6") CONT. HEADER AT GRND. CEILING LEVEL. TOE-NAILLED & GULLED AT TOP, BOTTOM PLATES AND HEADERS.



40. TYPICAL 1 HOUR RATED PARTYWALL

REFER TO DETAILS FOR TYPE AND SPECIFICATIONS.

41. FOUNDATION WALL (W.O.D./W.O.B.)







FOR LATERAL SUPPORT WHERE GRADE TO T/O BASEMENT SLAB EXCEEDS 1200mm (3'-11")

FOR 200mm (8") POURED CONC. FOUNDATION WALL PROVIDE VERTICAL 38x140 (2"x6") WOOD STUDS @ 400 (16") O.C. MATCH FLOOR JOIST SPACING WHEN PARALLEL WITH FLOOR JOISTS. (RAISE BOTTOM PLATE TO SLAB & FASTEN TOP OF WALL TO FLOOR JOIST AND

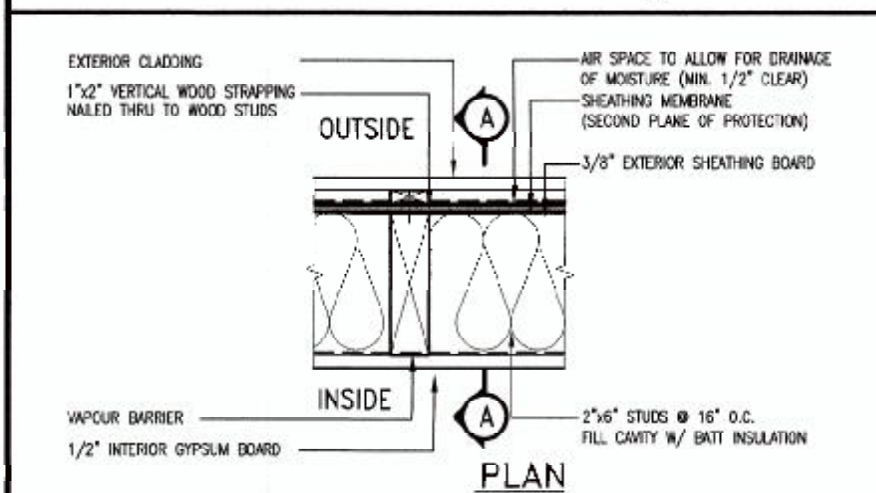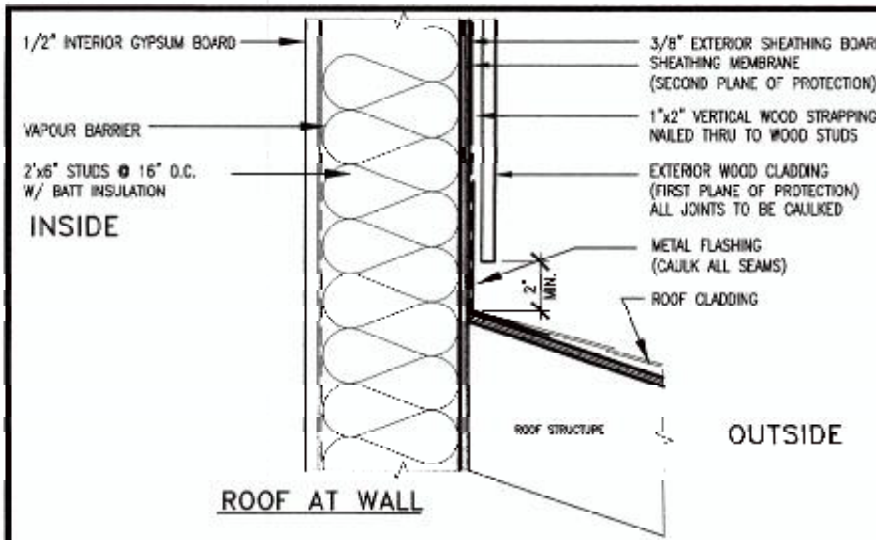

EXTERIOR WOOD CLADDING WALL ASSEMBLY

STUD WALL REINFORCEMENT FOR FUTURE GRAB BARS IN MAIN BATHROOM
 REINFORCEMENT OF STUD WALLS SHALL BE INSTALLED ADJACENT TO WATER CLOSETS AND SHOWER OR BATHTUB IN MAIN BATHROOM.
 FUTURE GRAB BARS TO BE INSTALLED TO RESIST HORIZ. AND VERT. LOADS OF 1.5 KN (300 LB)
 REFER TO OBC: DIV. B- 9.5.2.3. WATER CLOSET 3.8.3.8.(3)(c) & 3.8.3.8.(3)(c). SHOWER 3.8.3.13.(2)(1). BATHTUB & 3.8.3.13.(4)(c). AND DETAILS PROVIDED.

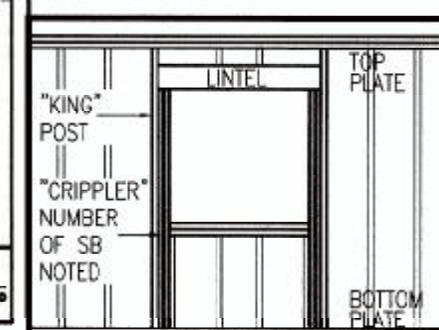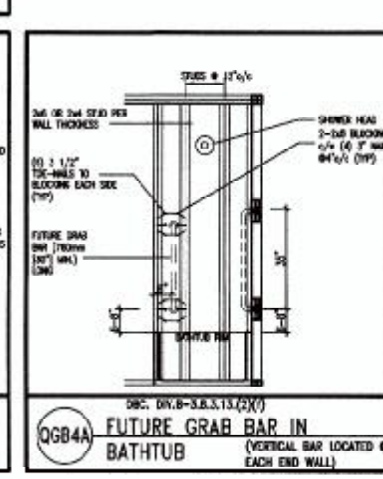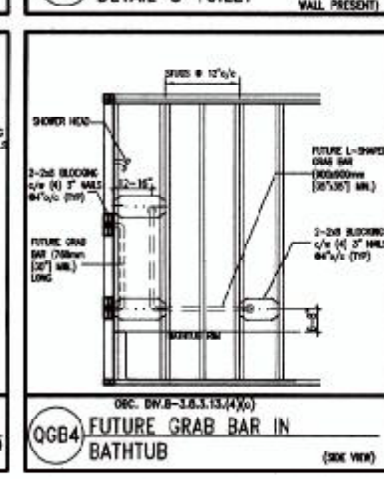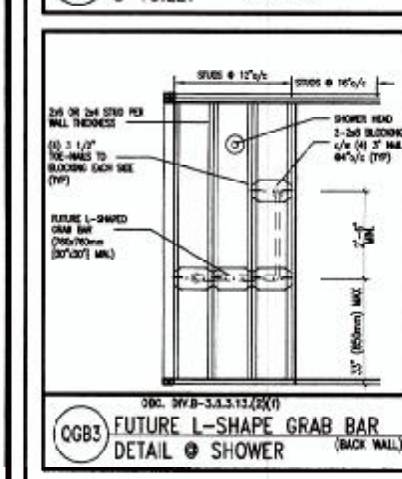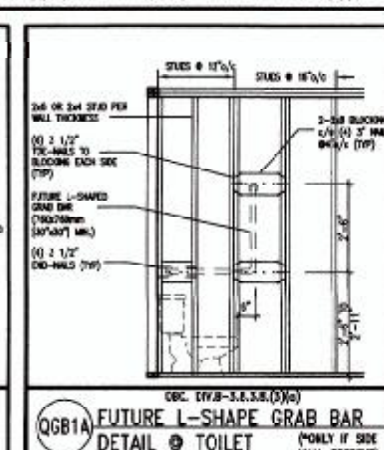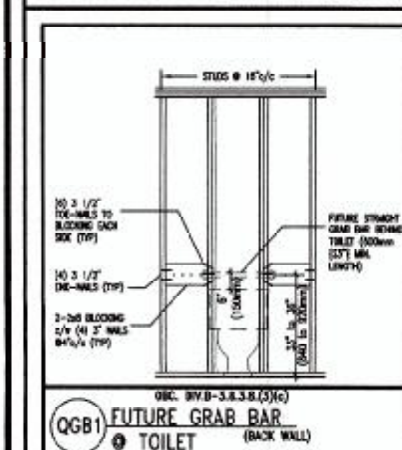

"CRIPPLE" DETAIL

**** MAX. HEIGHT FOR 2"x6" EXTERIOR WALL IS AS FOLLOW:**
 2"x6" @ 16" O.C. - 12'-6"
 2"x6" @ 12" O.C. - 13'-10"
 2"x6" @ 16" O.C. - 15'-0"
 2"x6" @ 12" O.C. - 17'-4"


MAX. HEIGHT FOR 2"x8" EXTERIOR WALL IS AS FOLLOWS:
 2"x8" @ 16" O.C. - 16'-0"
 2"x8" @ 12" O.C. - 17'-9"
 2"x8" @ 16" O.C. - 20'-4"
 2"x8" @ 12" O.C. - 22'-4"

- NOTES:**
- FOR ROOF DESIGN SNOW LOAD OF 2.5 KPa.
 - SUPPORTED ROOF TRUSS LENGTH OF 6.0m ONLY.
 - PROVIDE HORIZONTAL SOLID BLOCKING @ 1200 O.C. (4'-0")
 - PROVIDE A MINIMUM OF 9.5mm (3/8") PLYWOOD OR OSB EXTERIOR SHEATHING ON THE EXTERIOR FACE AND 12.5mm (1/2") GYPSUM BOARD ON THE INTERIOR FACE.
 - WALL FRAMING SHALL CONFORM TO OBC 9.2.3.10.1(2)
 - FOR A 1/50 YEAR REFERENCE WIND PRESSURE OF 0.6 KPa
 - STUDS GREATER THAN 9'-10" HIGH TO BE NO. 2 SPF.
 - STUD SPECIFICATION IS SUITABLE FOR BRICK VENEER OR SIDING.



**** STUD INFORMATION TAKEN FROM OBC TABLE A-30**

MAX. HEIGHT FOR 2"x4" GARAGE WALL IS AS FOLLOW:
 2"x4" @ 16" O.C. - 9'-10"
 2"x4" @ 12" O.C. - 10'-9"
 3-2"x4" @ 16" O.C. - 11'-2"
 3-2"x4" @ 12" O.C. - 12'-4"

- NOTES:**
- FOR ROOF DESIGN SNOW LOAD OF 2.5 KPa.
 - SUPPORTED ROOF TRUSS LENGTH OF 6.0m AND FLOOR JOIST LENGTH OF 2.5m OF ONE FLOOR.
 - PROVIDE HORIZONTAL SOLID BLOCKING @ 1200 O.C. (4'-0")
 - PROVIDE A MINIMUM OF 9.5mm (3/8") PLYWOOD OR OSB EXTERIOR SHEATHING ON THE EXTERIOR FACE.
 - FOR A 1/50 YEAR REFERENCE WIND PRESSURE OF 0.6 KPa.
 - STUDS GREATER THAN 9'-10" HIGH TO BE NO. 2 SPF.
 - STUD SPECIFICATION IS SUITABLE FOR BRICK VENEER OR SIDING.

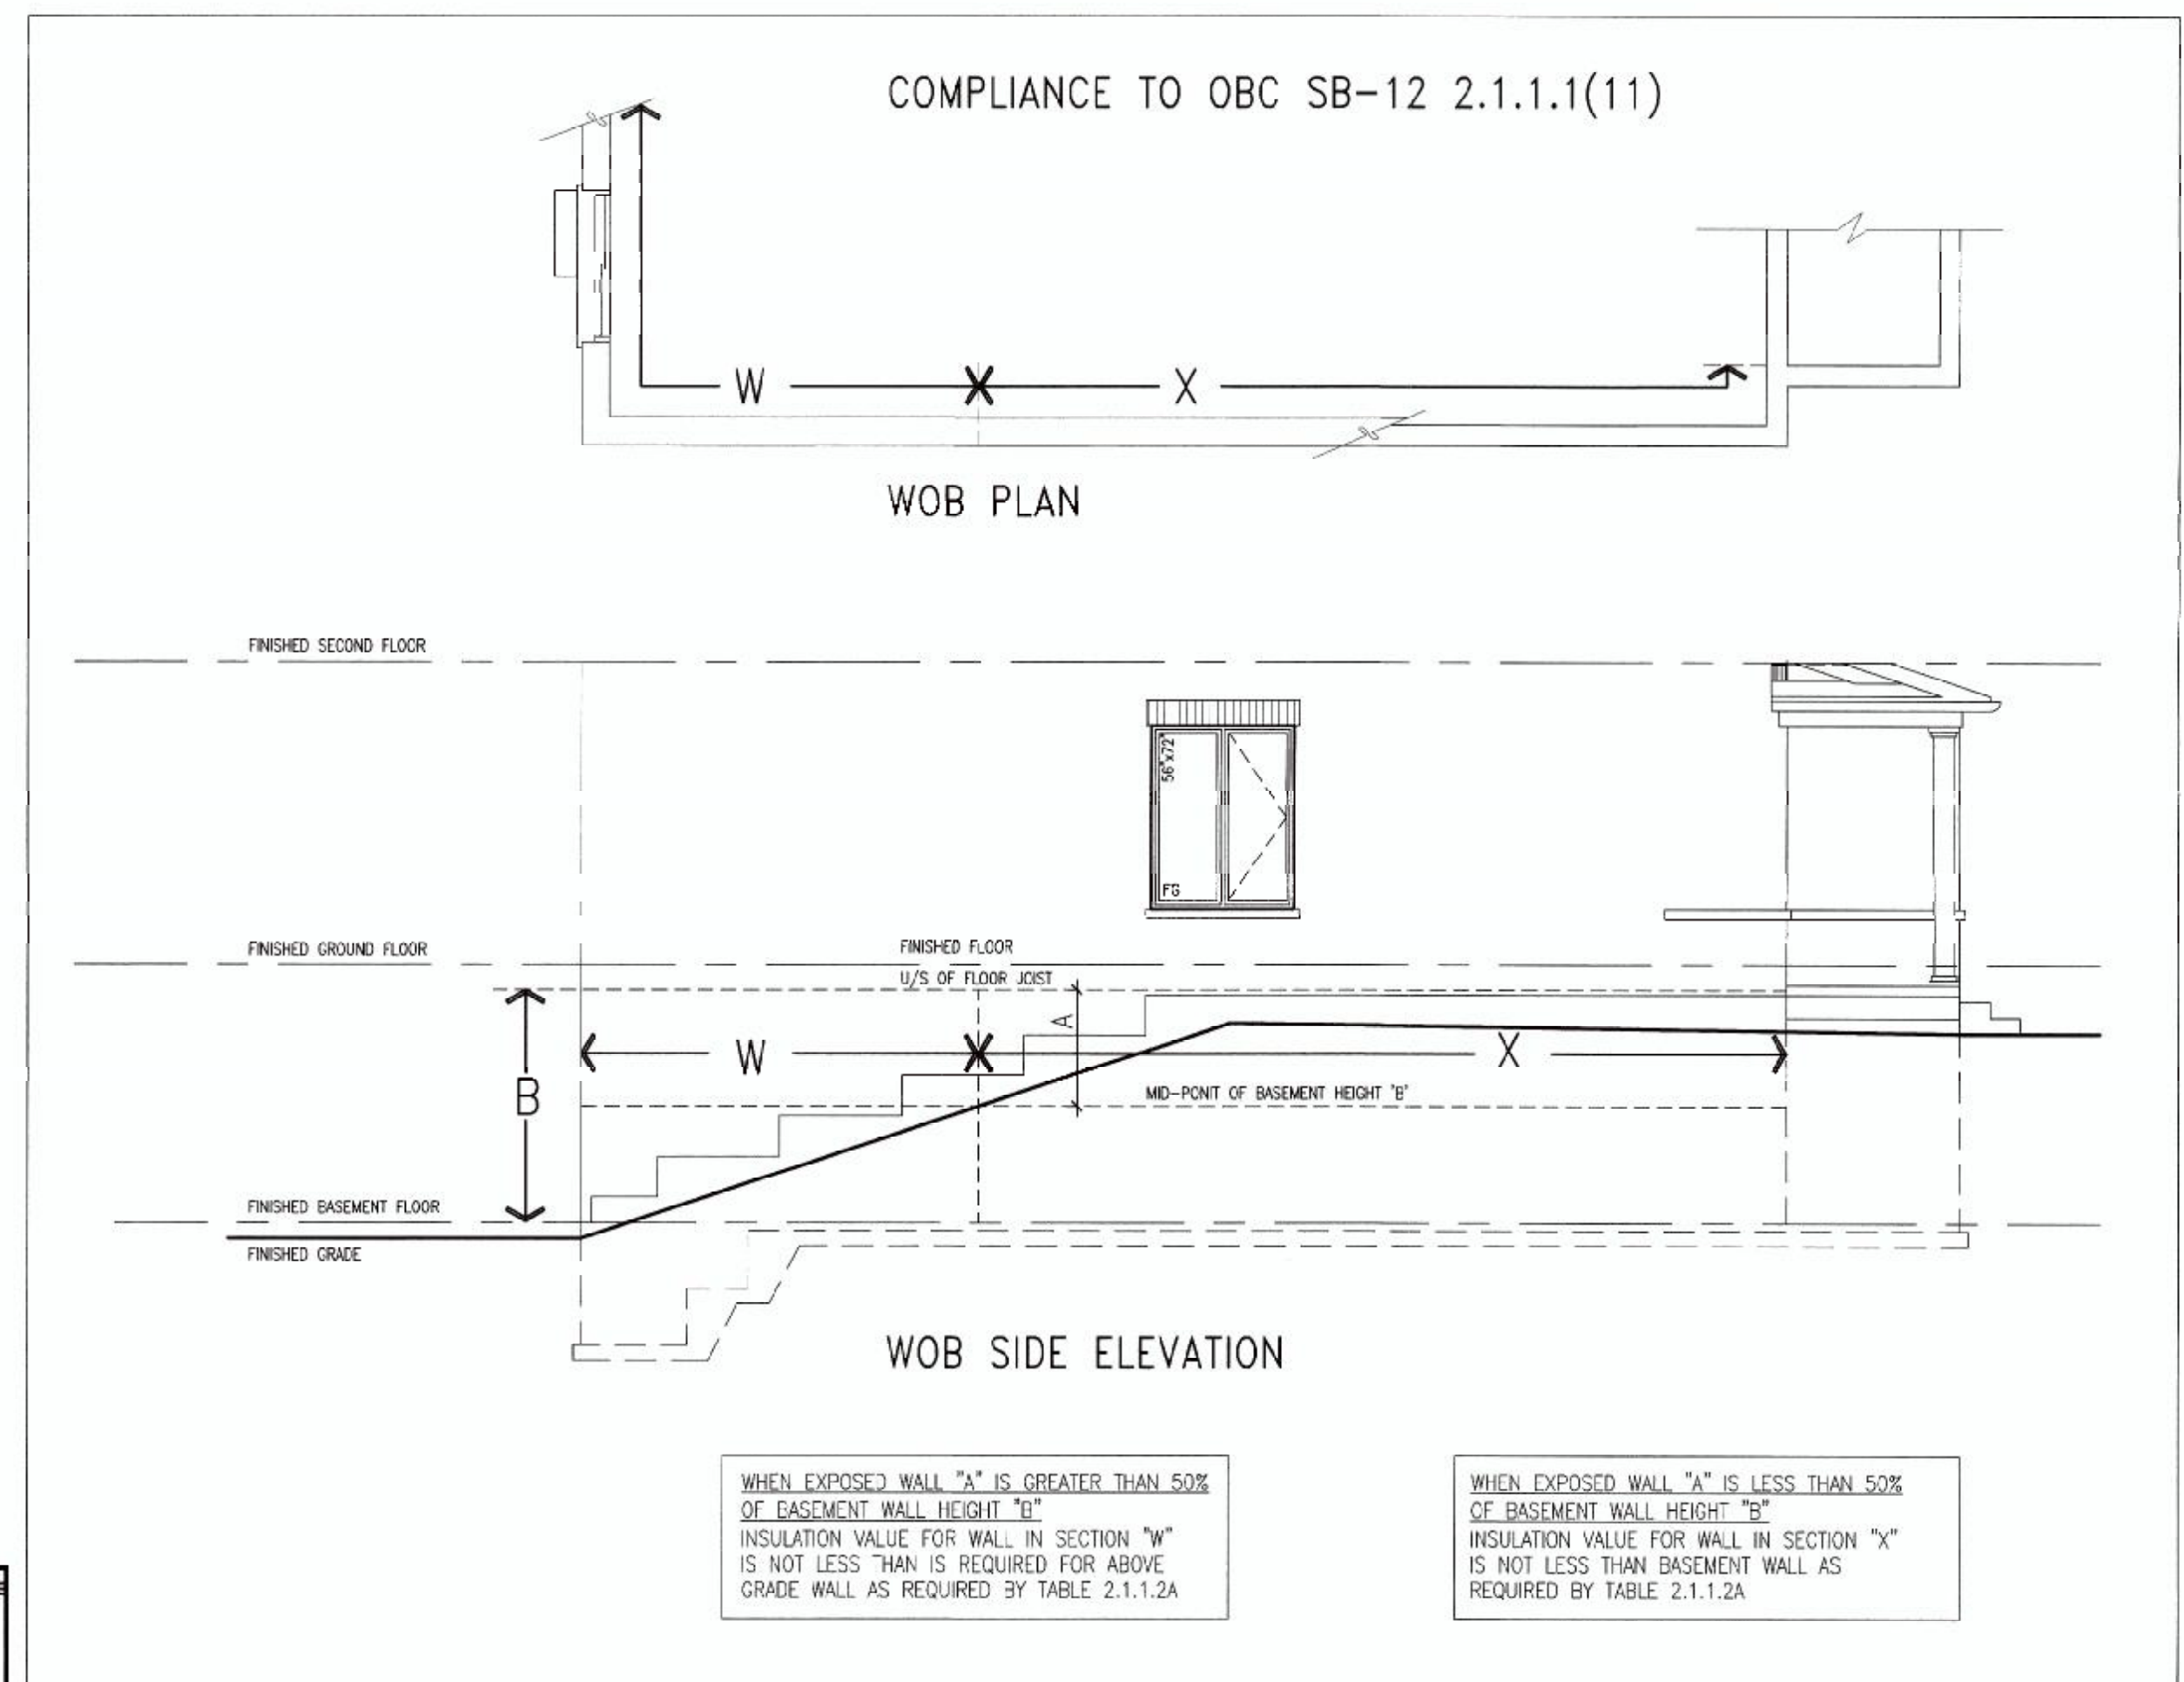

9. REVISED AS PER ENG'S COMMENTS MAY 19-17 RC 10. REV. FOR LOT 126 MAY 12-17 CL 11. REVISED GROUND FLOOR TO 9' HEIGHT APR 21-17 SB 12. REVISED AS PER ENG'S COMMENTS NOV 28-16 RC 13. ISSUED FOR CLIENT REVIEW 21-02-16 RC	The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. Wellington Jim-Baptiste 25591 name registration information VAS Design Inc. 42658 300A Wilson Avenue Toronto, ON M3H 1S8 416.533.9255 / 416.630.4782 vo3design.com	VA3 DESIGN 300A Wilson Avenue Toronto, ON M3H 1S8 416.533.9255 / 416.630.4782 vo3design.com BAYVIEW WELLINGTON Project name: GREEN VALLEY ESTATES BRADFORD, ON. date: AUG 2016 drawn by: RC checked by: RC scale: 3/16" = 1'-0" date: JUN 9, 2017 Project no: 13045 Sheet no: CN2 Sheet title: REAR ELEVATION WOOD
---	---	--

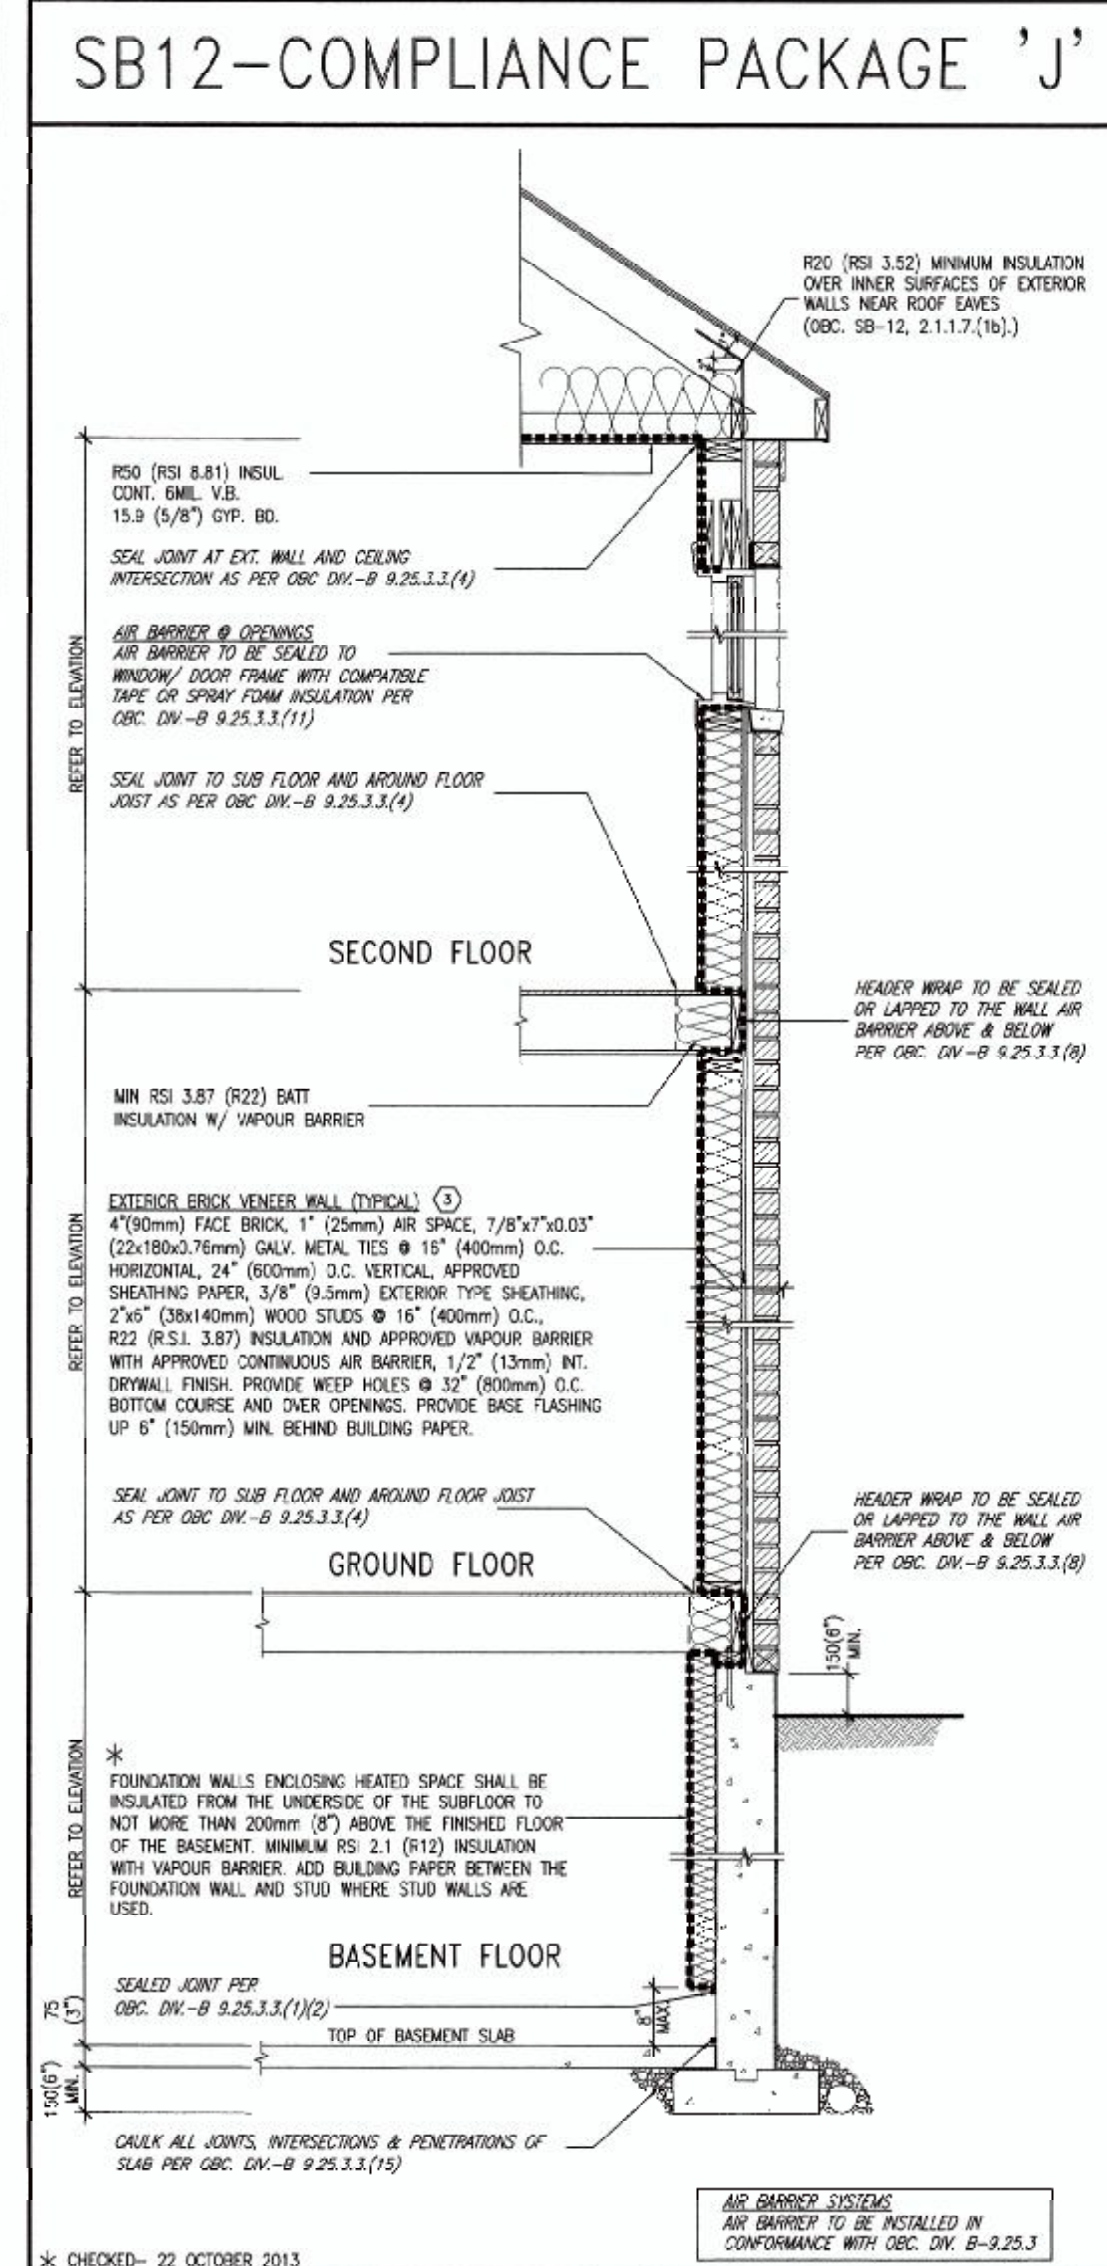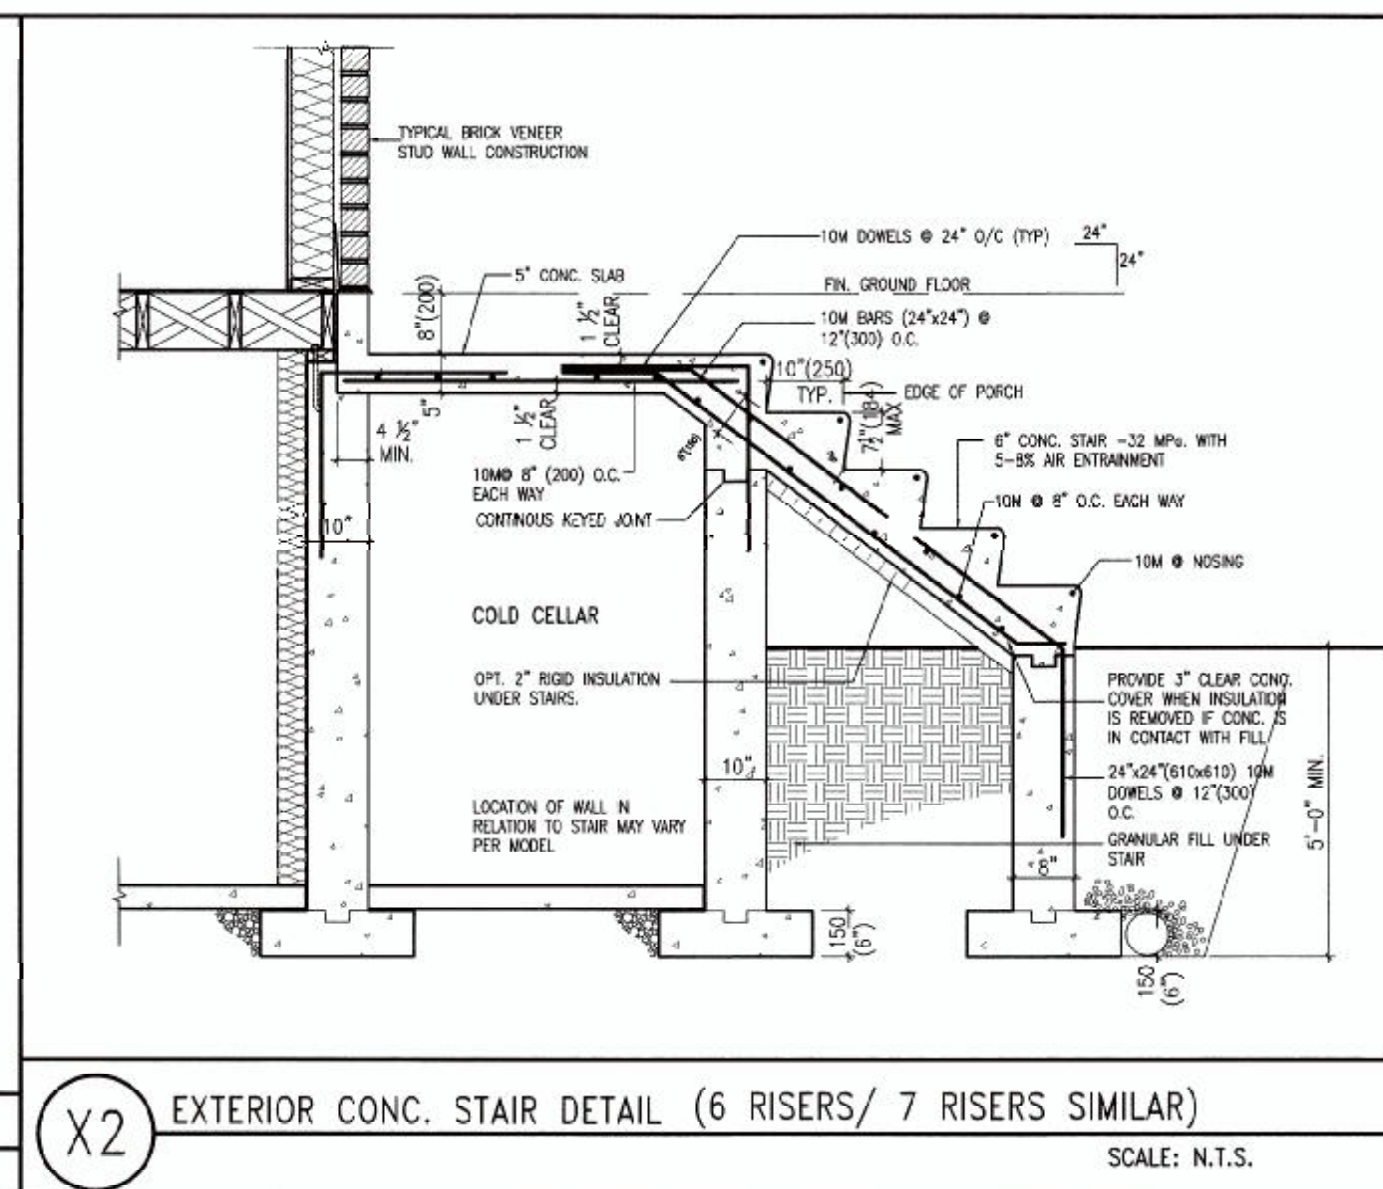

EW TYPICAL EXT. WALL AIR BARRIER CONTINUITY
SECTION W/ BRICK VENEER SCALE: N.T.S.

3					The undersigned has reviewed and taken responsibility for the design and has the qualifications to create the requirements and test on the following Building Code to be a Designer	
4					qualification information	
5					Wellington - see Baptiste	2
6						
7	REVISED AS PER ENG'S COMMENTS	MAY 19-17	RC			
8	REV. FOR LOT 126	MAY 12-17	CL		revision information	
9	REV. FOR FLOOR TO 9' HEIGHT	APR 21-17	SH			
10						
11	REVISED AS PER ENG'S COMMENTS	NOV 28-18	RC			
12	ISSUED FOR CLIENT REVIEW	21-09-18	RC			
13	DESCRIPTION	date	by			




V&A
DESIGN

BAYVIEW WELLINGTON


S60-2
ROTHCHILD 2

project name GREEN VALLEY ESTATES	project no. 13045
municipality BRADFORD, ON.	
date AUG 2016	drawing no. CN3
REAR ELEVATION	
drawn by RC	file name 13045-S60-2-LOT 126
checked by RC	scale 3/16" = 1'-0"
RICHARD - H:\ARCHIVE\WORKSHP\2015\13045\306\PLAN\13045-S60-2-LOT 126.dwg - Fri - May 13 2017 - 3:29 PM	

CN3

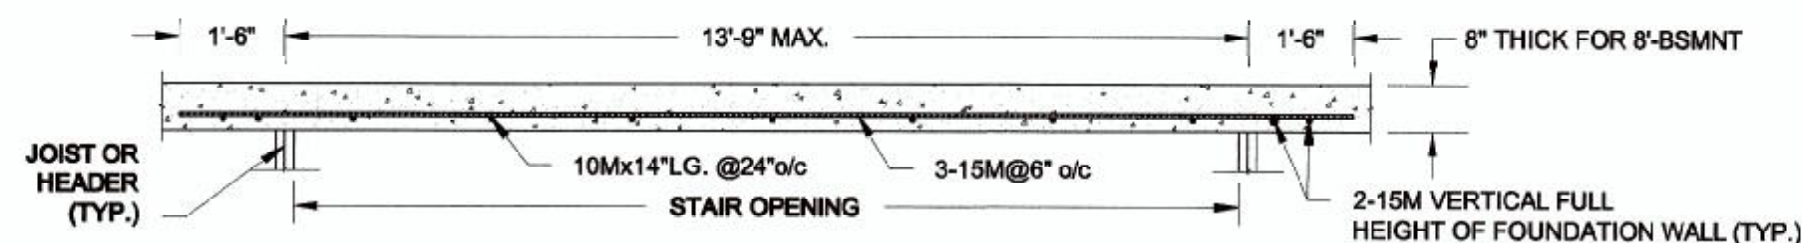


PLAN VIEW

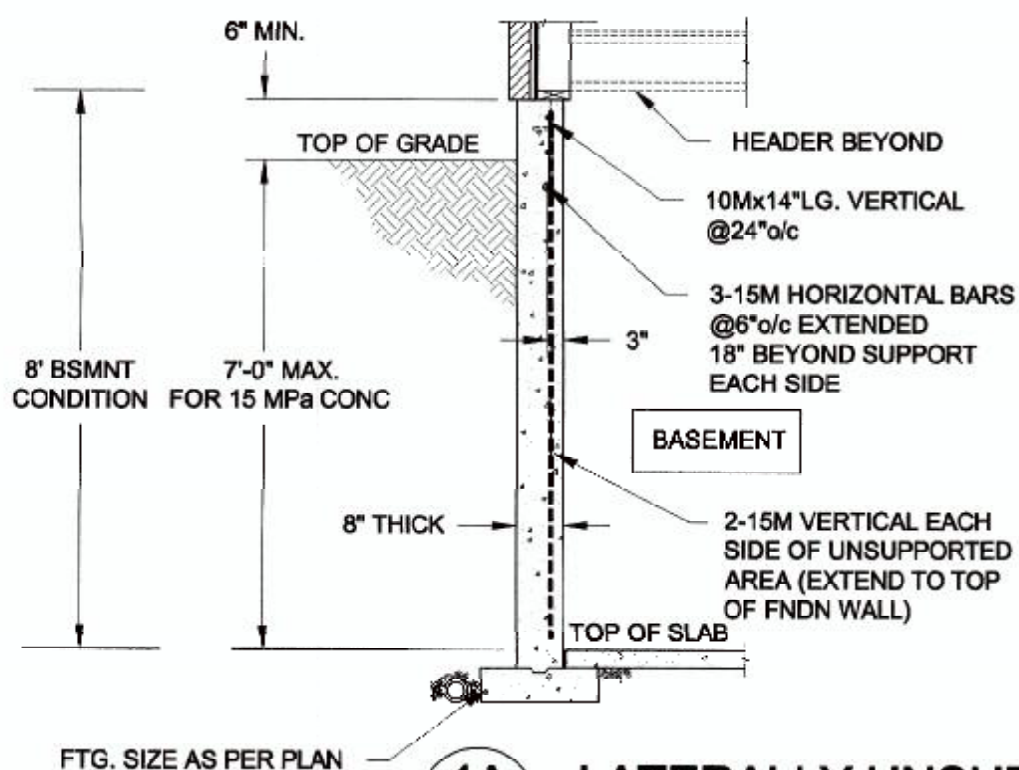


1A LATERALLY UNSUPPORTED WALL
S1 SCALE: 3/8\"/>

- NOTES:
1. CONFORM TO ONTARIO BUILDING CODE, 2012.
 2. FOR 8'-BSMNT WHERE BACKFILL HEIGHT = 7'-0\"/>
 3. REINFORCING STEEL TO BE GRADE 400.

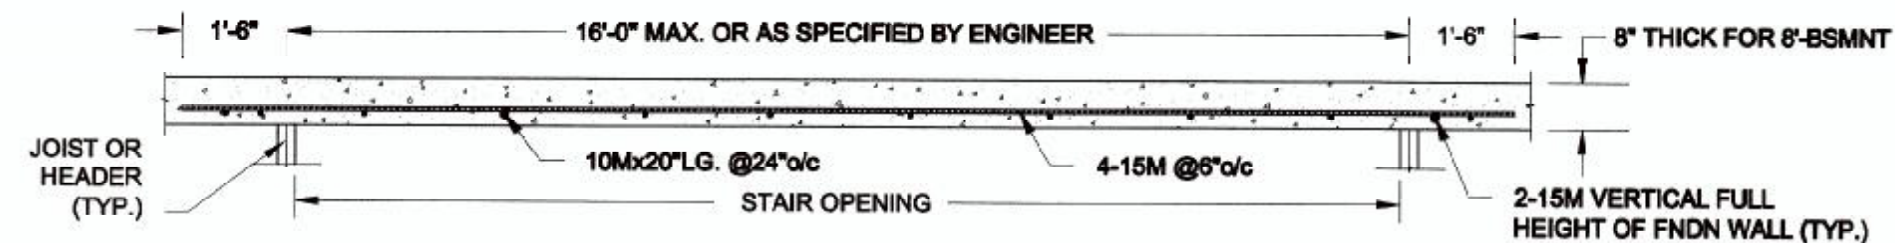


PLAN VIEW

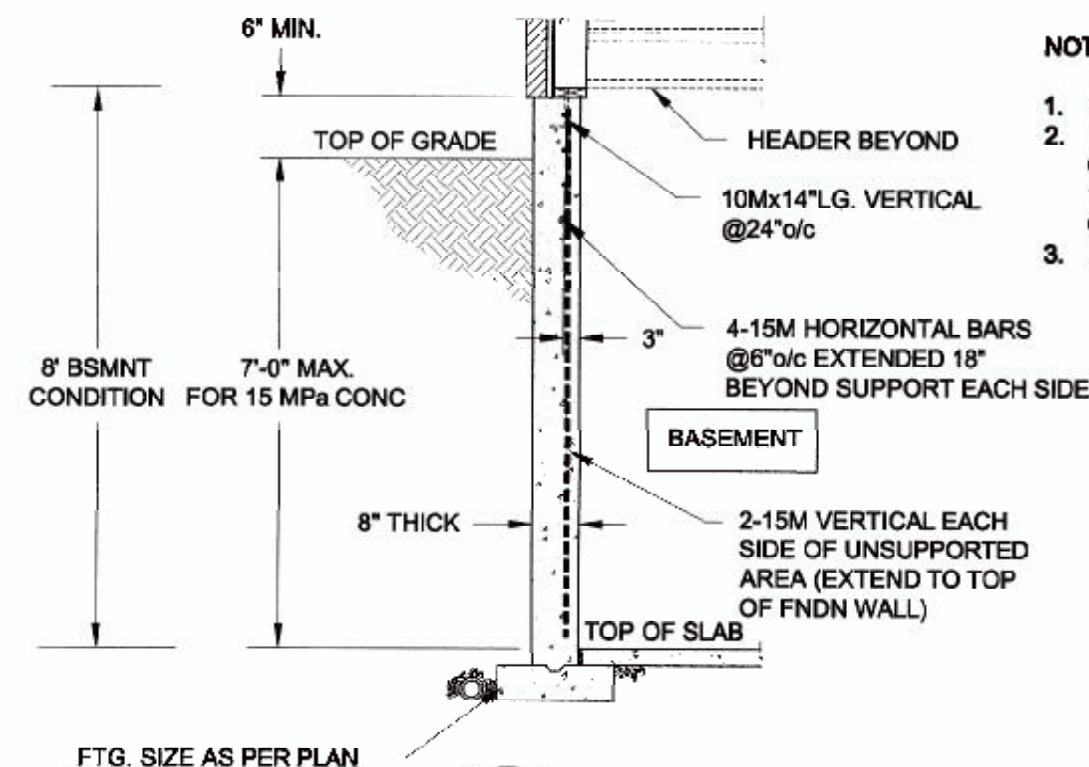

1B LATERALLY UNSUPPORTED WALL
S1 SCALE: 3/8\"/>

- NOTES:
1. CONFORM TO ONTARIO BUILDING CODE, 2012.
 2. FOR 8'-BSMNT WHERE BACKFILL HEIGHT = 7'-0\"/>
 3. REINFORCING STEEL TO BE GRADE 400.

FOR 9 1/2\"/>

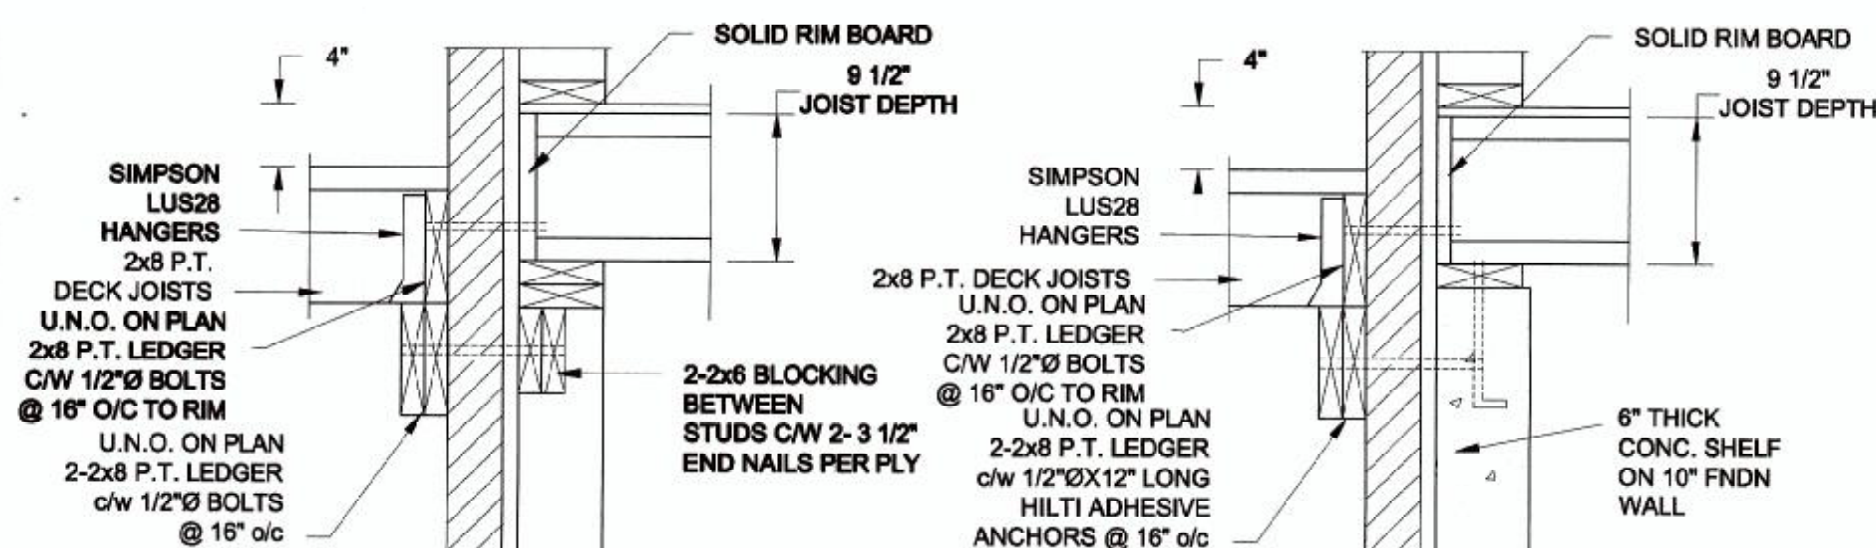


1A DECK FASTENING DETAIL
S2 SCALE: 1\"/>

1B DECK FASTENING DETAIL
S2 SCALE: 1\"/>

- NOTE: 1. WHERE BACKFILL HEIGHT < 4'-7\", PROVIDE 2x6 @ 16\"/>


FOR 11 7/8\"/>

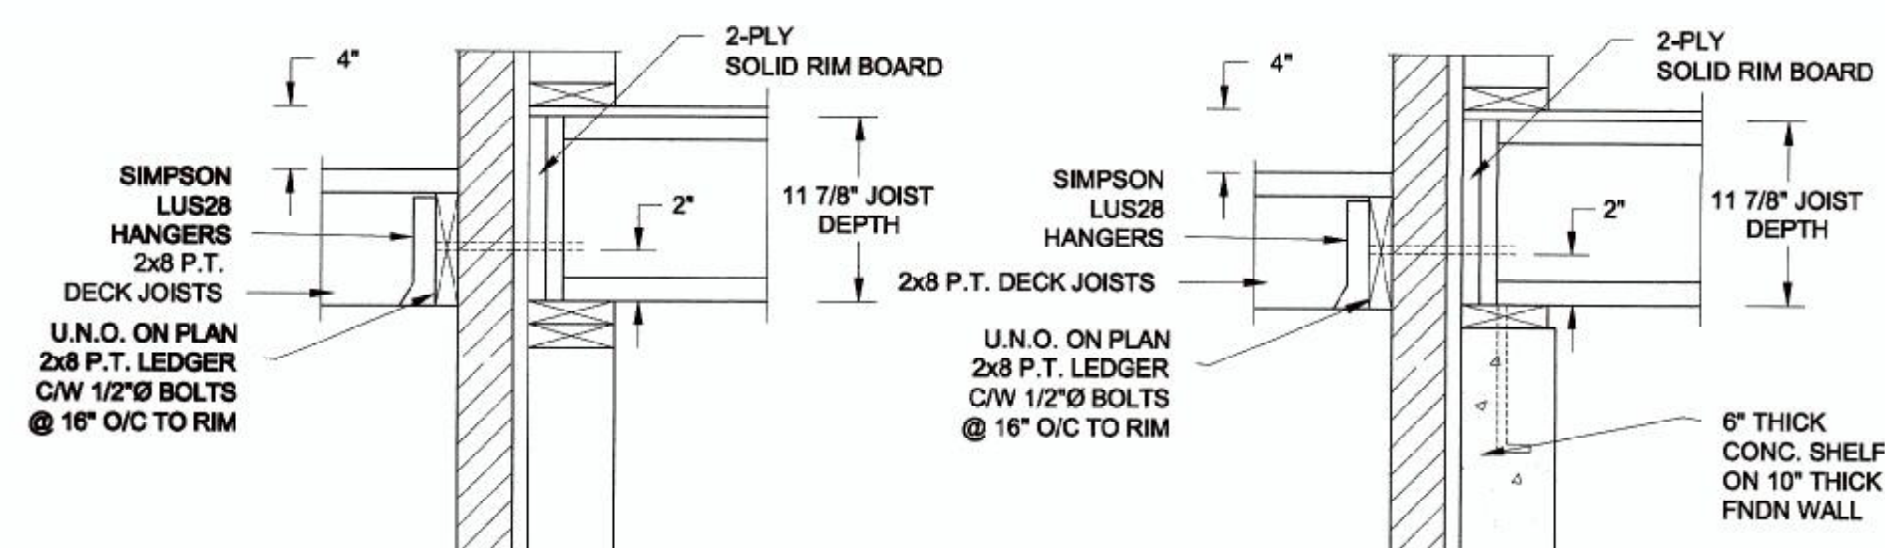

2A DECK FASTENING DETAIL
S2 SCALE: 1\"/>


2B DECK FASTENING DETAIL
S2 SCALE: 1\"/>

- NOTE: 1. WHERE BACKFILL HEIGHT < 4'-7\", PROVIDE 2x6 @ 16\"/>

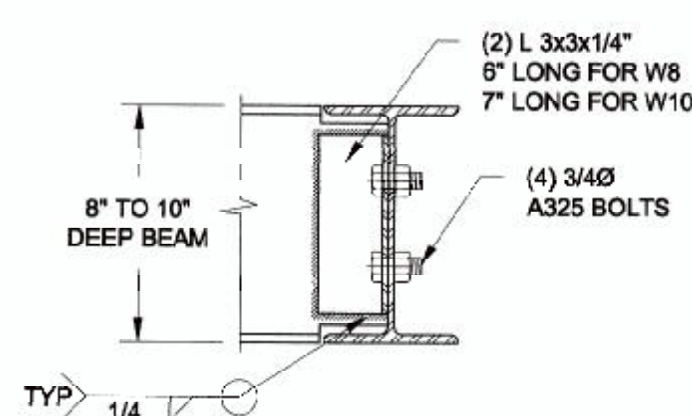

NOTE: DETAIL IS APPLICABLE TO W8x40 (W200x59) BEAM MAX AND W10x39 (W250x58) BEAM MAX.

3 STEEL BEAM CONNECTION DETAIL
S2 SCALE: 1-1/2\"/>

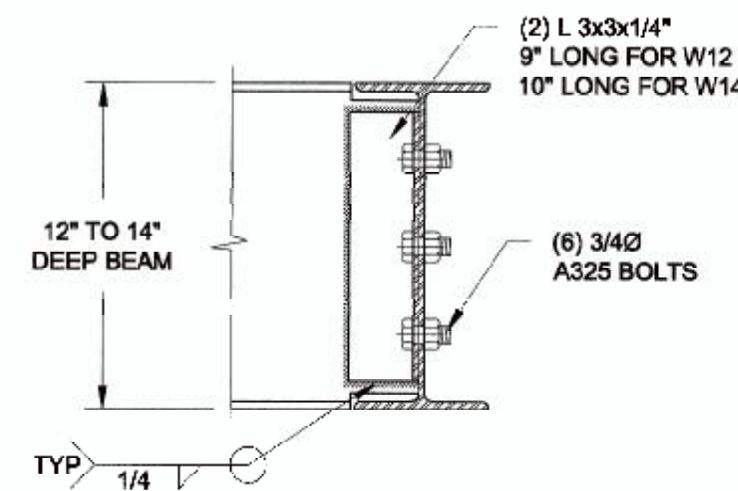

NOTE: DETAIL IS APPLICABLE TO W12x58 (W310x88) BEAM MAX AND W14x48 (W360x72) BEAM MAX.

No.	DESCRIPTION	DATE
REVISIONS		


QUAIL ENGINEERING LTD.
38 Parkside Drive, UNIT 7
Newmarket, ON L3Y 8J7
T: 905-553-5547
E: quail.eag@rogers.com

BAYVIEW WELLINGTON HOMES
GREEN VALLEY ESTATES
BRADFORD, ONTARIO


NO. 16-102	AS NOTED
DATE NOV-02-2016	

STRUCTURAL DETAILS AND NOTES


Q1

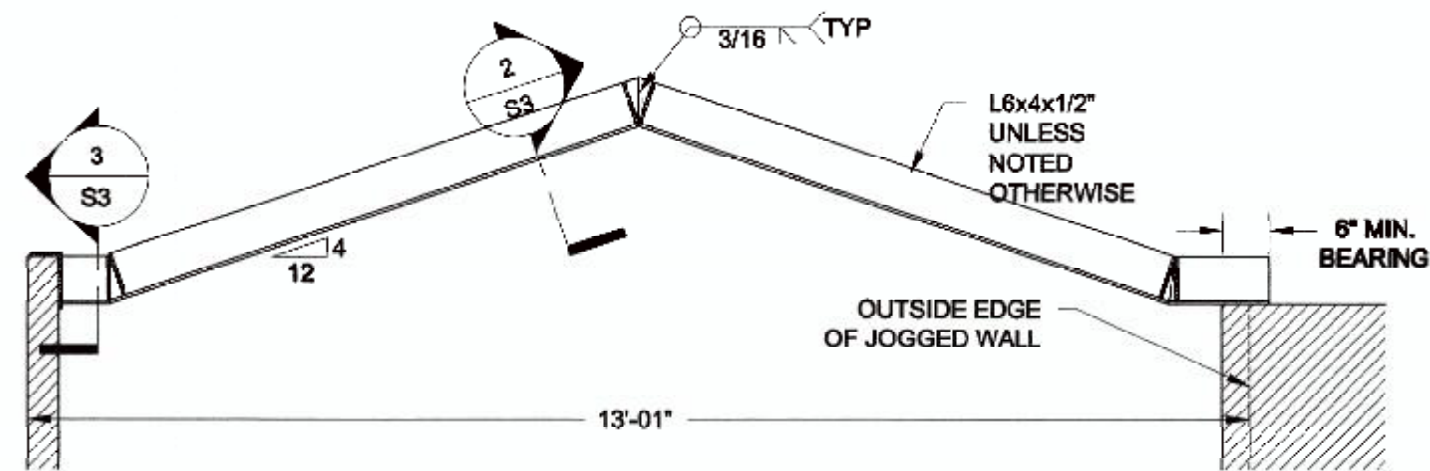


1 STEEL LINTEL AT GABLE
SCALE: 1/2" = 1'-0"

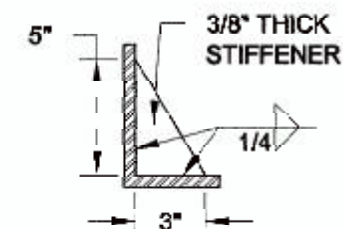

2 TYP. STIFFENER
SCALE: 1 1/2" = 1'-0"

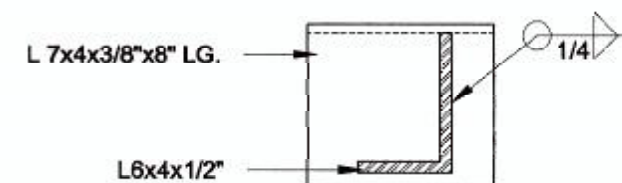


3 INVERTED ANGLE
SCALE: 1 1/2" = 1'-0"

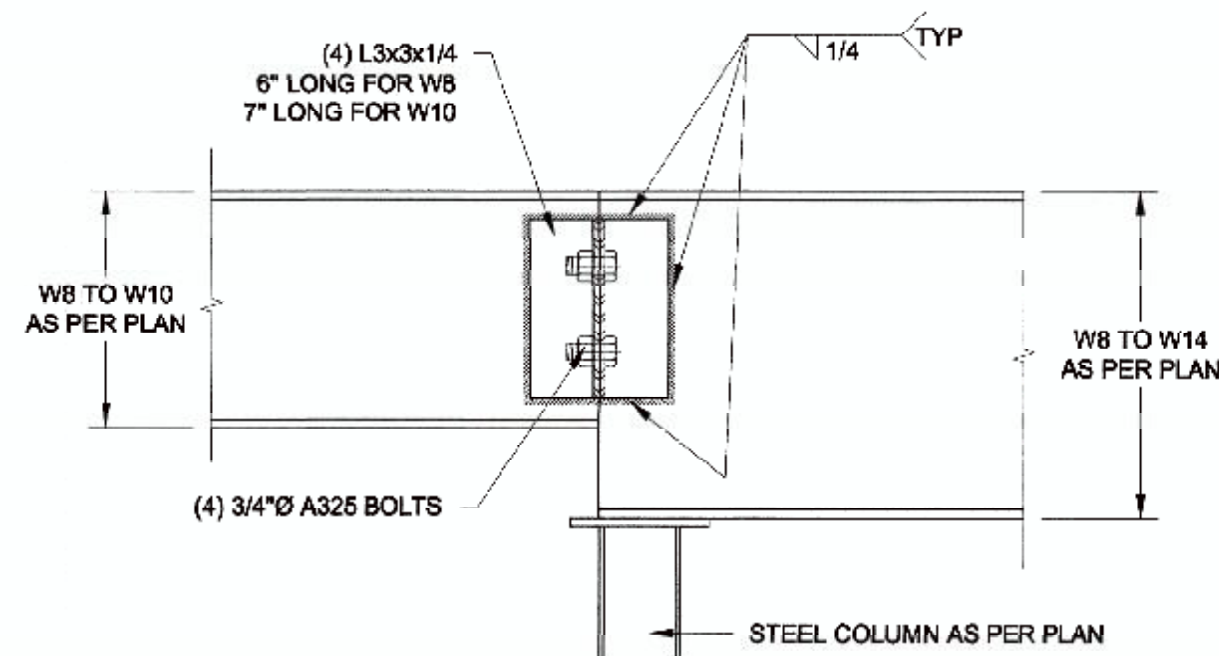



4 STEEL BEAM CONNECTION
SCALE: 1 1/2" = 1'-0"

FOR 9 1/2" JOIST DEPTH

FOR 11 7/8" JOIST DEPTH

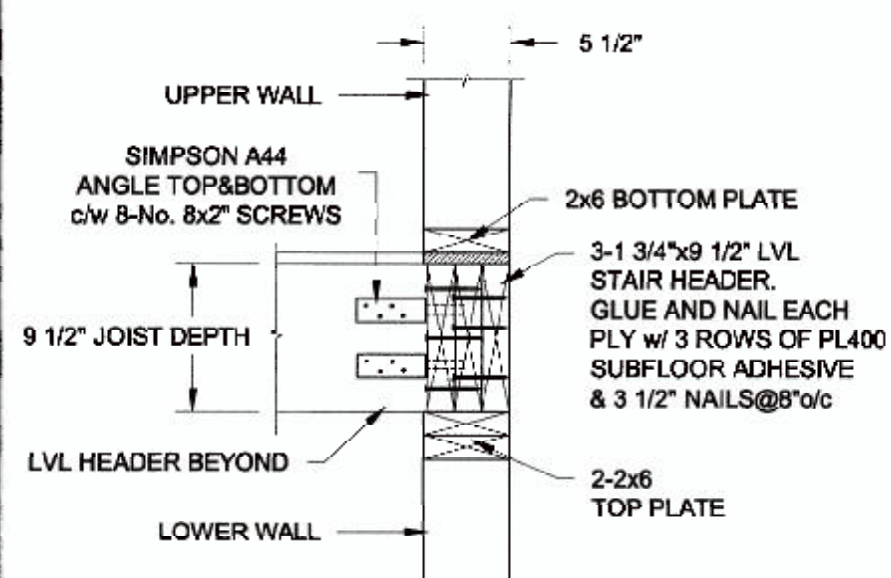

2 STAIR HEADER @ EXTERIOR WALL
SCALE: 1" = 1'-0"

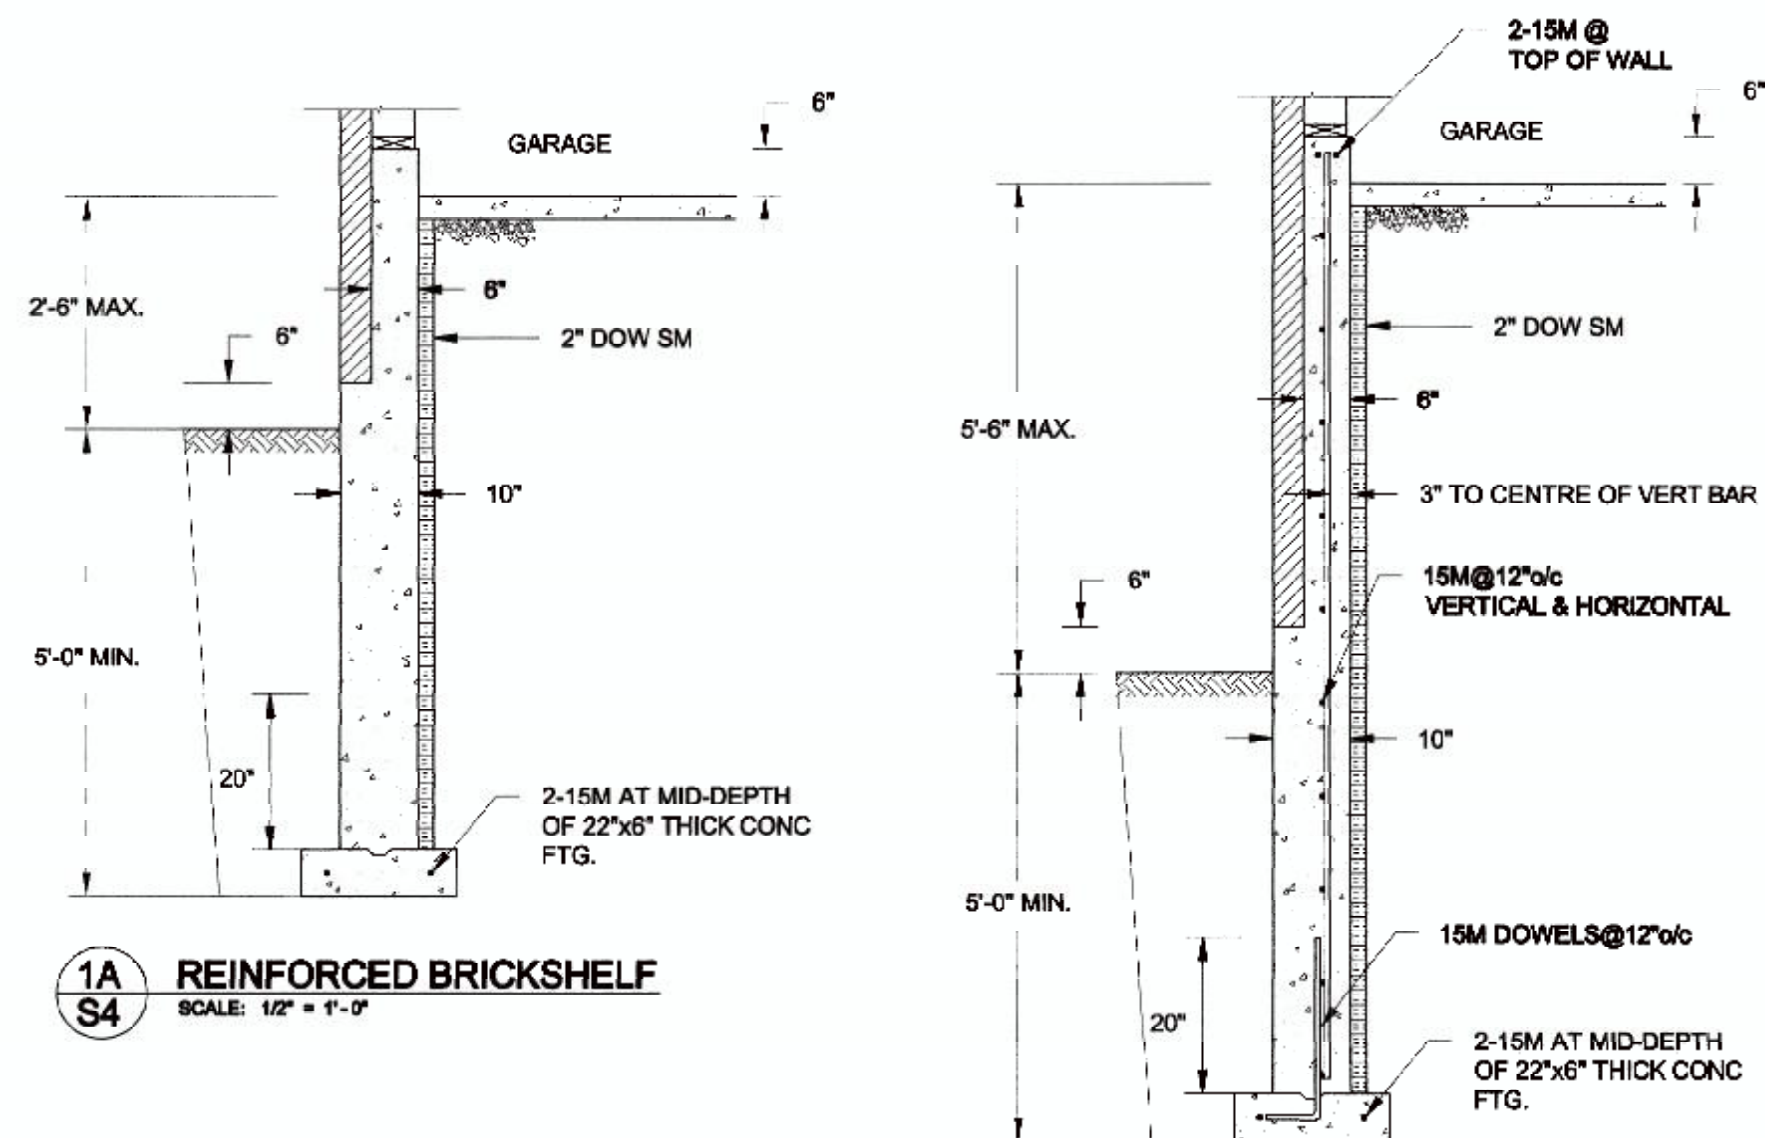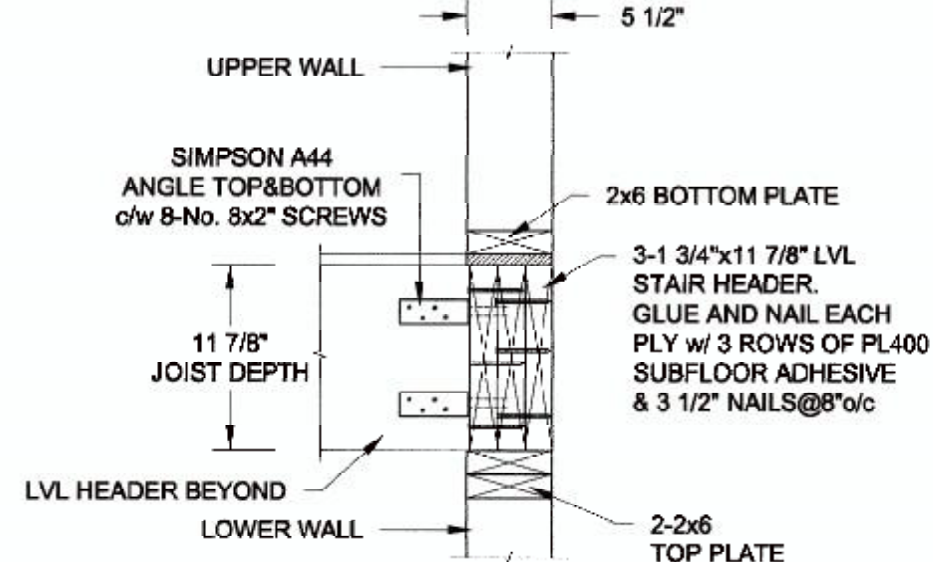


1A REINFORCED BRICKSHELF
SCALE: 1/2" = 1'-0"


1B REINFORCED BRICKSHELF
SCALE: 1/2" = 1'-0"

NOTE:

1. CONFORM TO ONTARIO BUILDING CODE, 2012.
2. CONCRETE TO HAVE 28-DAY COMPRESSIVE STRENGTH OF 20 MPa.
3. REINFORCING BARS TO BE GRADE 400 DEFORMED STEEL.
4. PROVIDE 3" COVER TO SOIL MINIMUM.

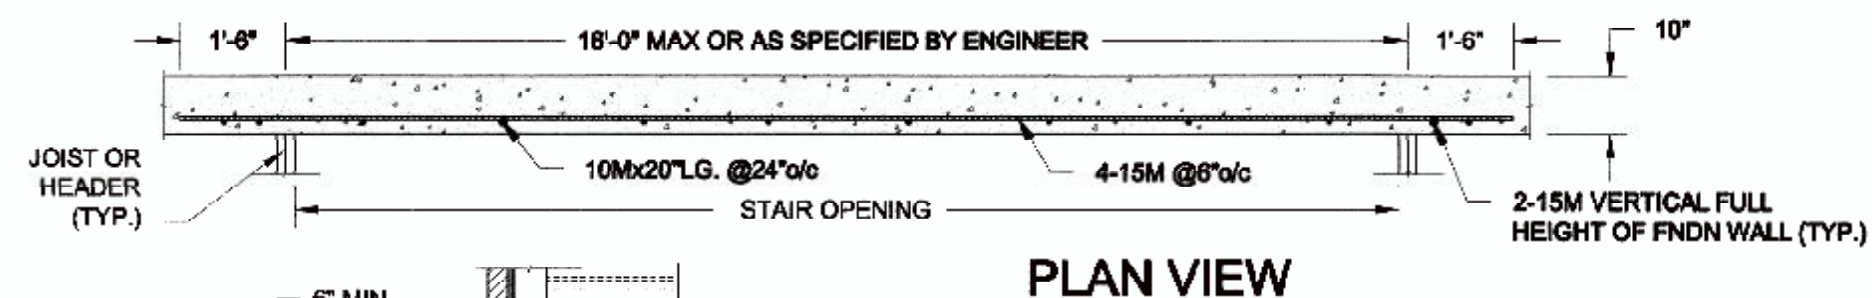

PLAN VIEW

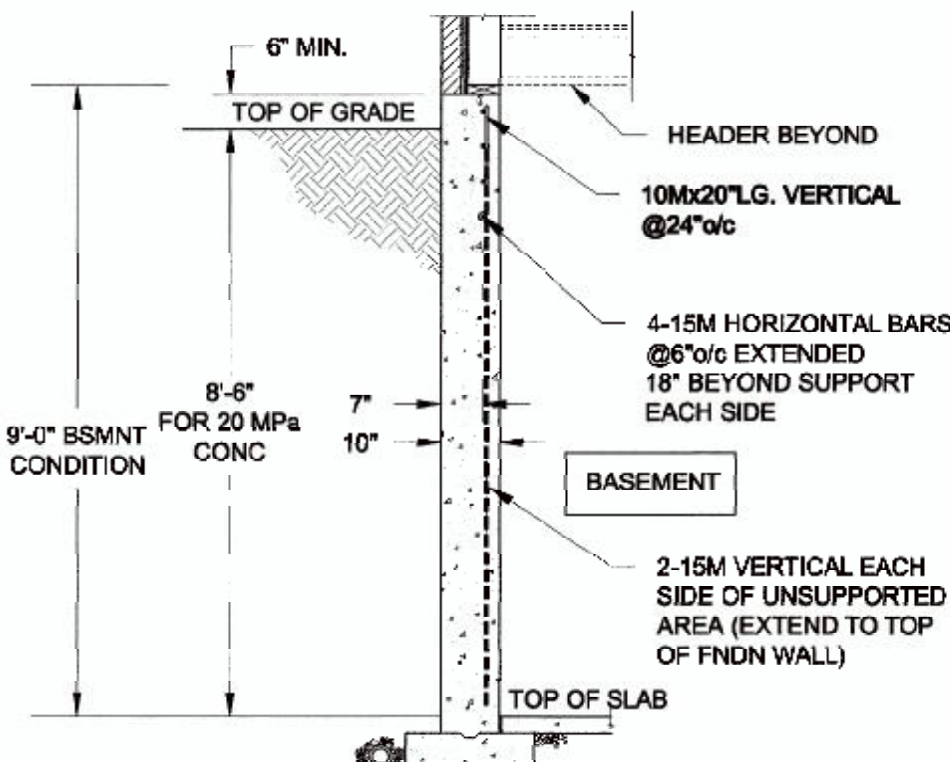

1 LATERALLY UNSUPPORTED WALL
SCALE: 3/8" = 1'-0"

NOTE:

1. CONFORM TO ONTARIO BUILDING CODE, 2012.
2. CONCRETE COMPRESSIVE STRENGTH AT 28 DAYS TO BE 20 MPa. MIN.
3. REINFORCING STEEL TO BE GRADE 400.

No.	DESCRIPTION	DATE
	REVISIONS	



QUAILE ENGINEERING LTD.

38 Parkside Drive, UNIT 7
Newmarket, ON
L3Y 8J9
T: 905-853-8547
E: quaile.eng@rogers.com

**BAYVIEW WELLINGTON HOMES
GREEN VALLEY ESTATES
BRADFORD, ONTARIO**

PROJECT NO.	16-102	DATE	NOV 14, 2016
DESIGNED BY	SJB	CHECKED BY	SJB
APPROVED BY		DATE	
STRUCTURAL DETAILS AND NOTES			Q2