

NOTE: SPACE ALL FLOOR JOISTS @ 12" O.C. UNDER ALL CERAMIC TILE AREAS.

NOTE: ALL LVL'S SUPPORTING FLOOR LOADS ARE TO BE SPECIFIED BY FLOOR TRUSS MANUFACTURER.

NOTE: FLOOR FRAMING INFO REFER TO SHOP DRAWINGS FOR ALL TRUSS—JOIST INFORMATION AND DETAILS. UNLESS OTHERWISE NOTED.

NOTE J1: PROVIDE SOLID BLOCKING
© 24" O.C. WHERE FLOOR JOISTS ARE
PARALLEL TO FOUNDATION WALL (TYP.)

_					*				
L	<u>UNINSULATED OPENI</u>	NGS (PER OB	C. SB-12,3.1.1	UNINSULATED OPENINGS (PER OBC. SB-12,3.1.1(7))					
	SD25-4 COR LOT 154 ELE A WOD	ENERGY E	fficiency — oi	BC SB12	SD25-4 COR LOT 154 ELE A WOD	ENERGY E	FFICIENCY - OF	3C S812	
	ELEVATION	WALL AREA S.F.	OPENING S.F.	PERCENTAGE	ELEVATION	WALL AREA S.F.	OPENING S.F.	PERCENTAGE	
0	FRONT	451 S.F.	99.304 S.F.	22.02 %	FRONT	451 S.F.	99.304 S.F.	22.02 %	
	LEFT SIDE	1127 S.F.	154 S.F.	13.66 %	LEFT SIDE	1127 S.F.	154 S.F.	13.66 %	
	RIGHT SIDE	1127 S.F.	0 S.F.	0.00 %	RIGHT SIDE	1127 S.F.	0 S.F.	0.00 %	
	REAR 4-8R WOD COND	526 S.F.	94.833 S.F.	18.03 %	REAR 9R AND MORE WOD COND	526 S.F.	103.167 S.F.	19.61 %	
	* OPENINGS OMITTED AS PER SB-12 3.1.1.9(4) MAX 19.9 S.F. REFER TO ELEVATION FOR LOCATION		0 S.F.		* OPENINGS OMITTED AS PER SB-12 3.1.1.9(4) MAX 19.9 S.F. REFER TO ELEVATION FOR LOCATION		0 S .F.		
	TOTAL SQ. FT.	3231.00 S.F.	348.14 S.F.	10.77 %	TOTAL SQ. FT.	3231.00 S.F.	356.47 S.F.	11.03 %	
	TOTAL SQ. M.	300.17 S.M.	32.34 S.M.	10.77 %	TOTAL SQ. M.	300.17 S.M.	33.12 S.M.	11.03 %	
ındereiç	tersigned has reviewed and takes responsibility for this design								

Ortario Building Code to be a Designer.
qualification information

Welltington Jno-Baptiste

Signature

Signature

Signature

Signature

Signature

Signature

A 2658

Contractor must verify all dimensions on the job and report any
discrepancy to the Designer before proceeding with the work. All
drawings and specifications are instruments of service and the property
of the Designer which must be returned at the completion of the work.

Drawings are not to be scaled.

ı	V
ı	DECION
Į	DESIGN
I	255 Consumers Rd Suite 120 Toronto ON M2J 1R4
ı	t 416.630.2255 f 416.630.4782
	va3design.com

		BAY	IEW	WEL	INGT	ON
1	pr <mark>oje</mark> ct nar <mark>ne</mark> GREEN	VALLEY	EAST	В	RADFORD	EAST,
- 1	date					DAD

SD25-4 SONOMA 4 COR Project in 16023

9A


 dctes
 PARTIAL PLAN WOD COND


 dcrown by
 checked by
 scole
 file name

 NC
 RC
 3/16" = 1'-0"
 16023-SD25-4COR


ON.

drawings specifications, related documents and design are the copyright property of VAS DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VAS DESIGN's written permiss

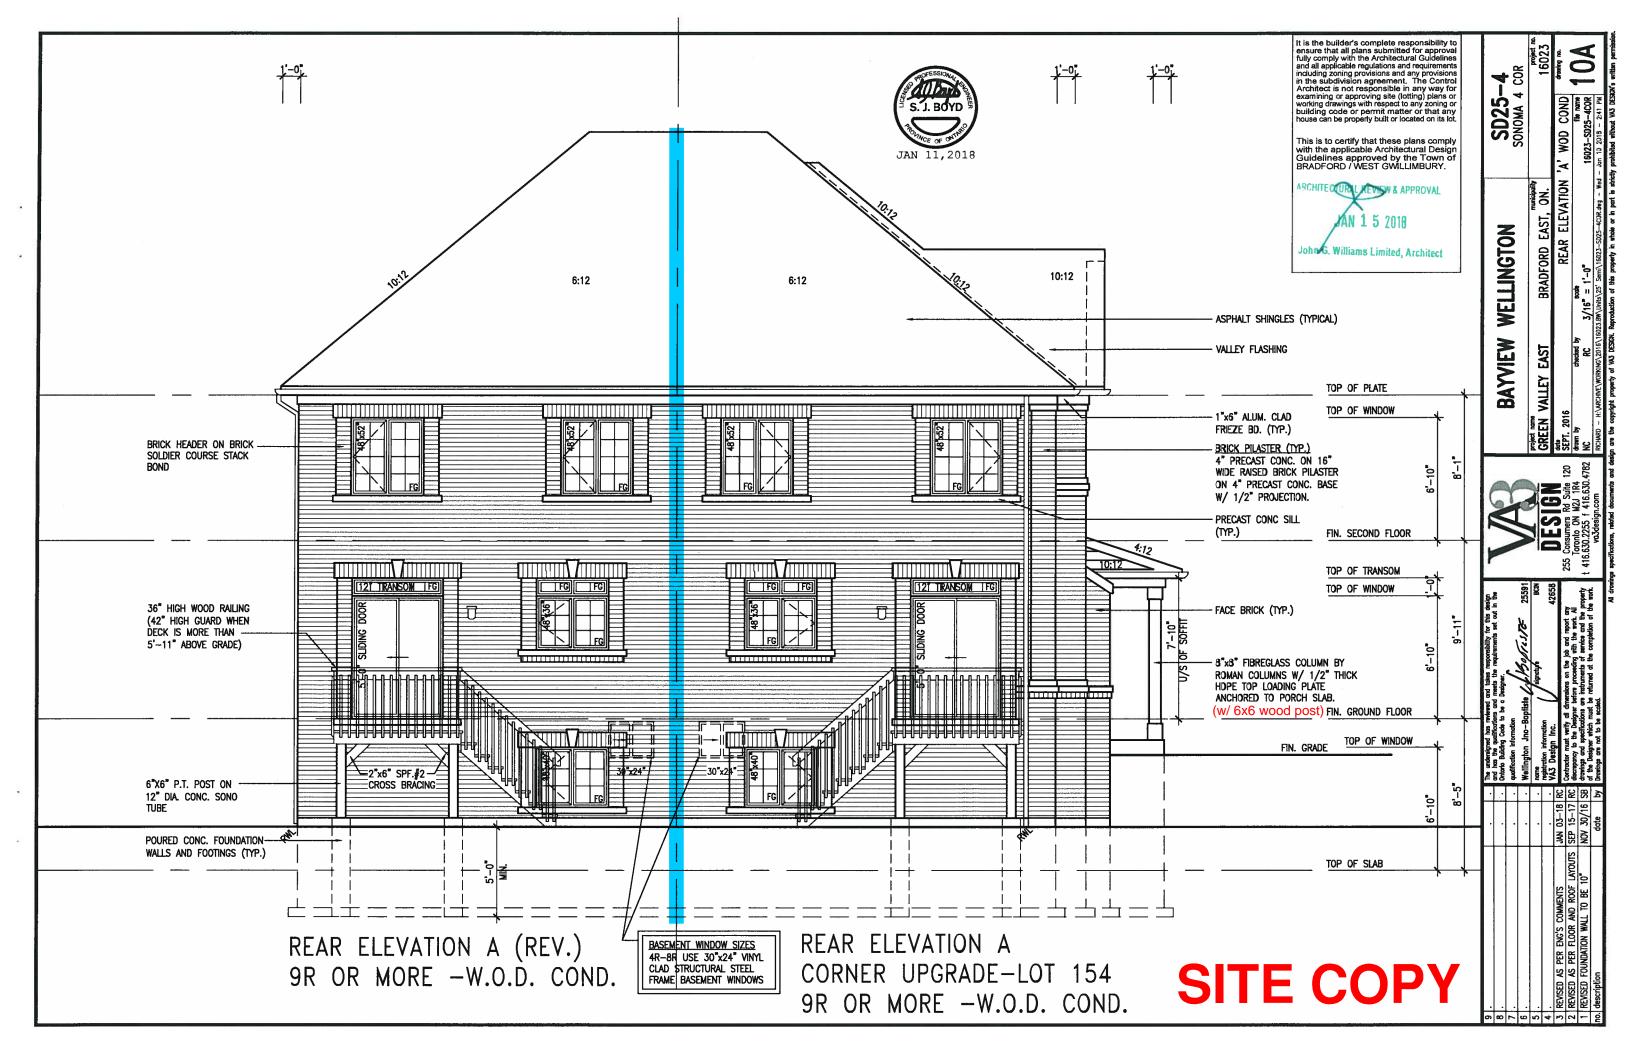


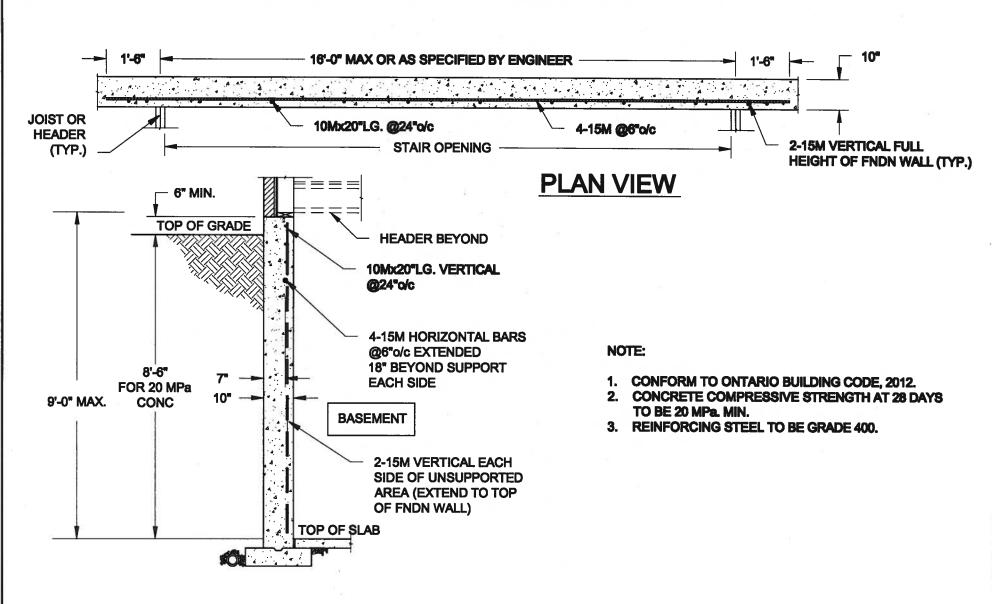



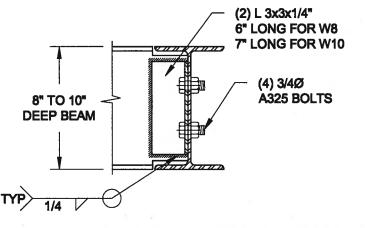

NOTE: DETAIL IS APPLICABLE TO W8x40 (W200x59) BEAM MAX AND W10x39 (W250x58) BEAM MAX.

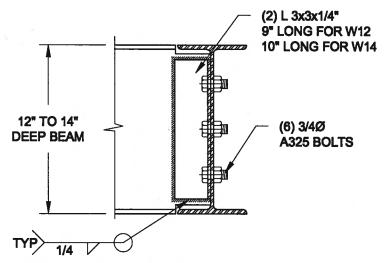


NOTE: DETAIL IS APPLICABLE TO W12x58 (W310x86) BEAM MAX AND W14x48 (W360x72) BEAM MAX.





R. Samo of Selfy 17-194 Earness Wellington Green Valley Sings (17-194 daing

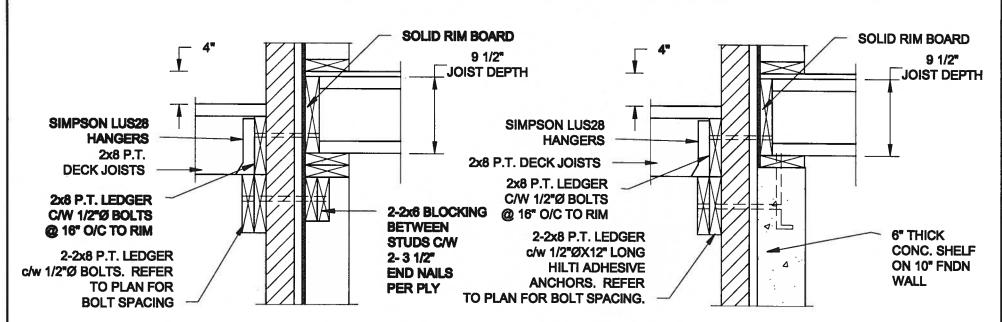


DECK FASTENING DETAIL SCALE: 1" = 1'-0"

DECK FASTENING DETAIL 1B SCALE: 1" = 1'-0"


NOTE: 1.

WHERE BACKFILL HEIGHT < 4'-7", PROVIDE 2x6 @ 16" o/c KNEEWALL ON 10" THICK CONC FNDN WALL WHERE BACKFILL HEIGHT > 4'-7", PROVIDE 6" CONC SHELF FOR BRICK VENEER ON 10" THICK CONC FNDN WALL 2.

FOOTING TO BE 22"x6" THICK UNLESS NOTED OTHERWISE ON PLAN.

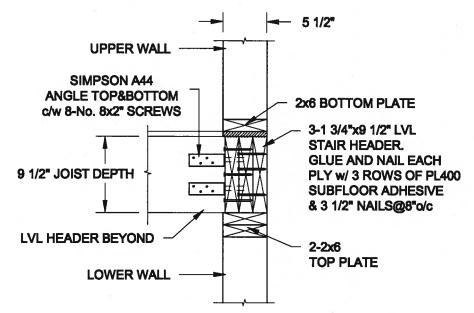



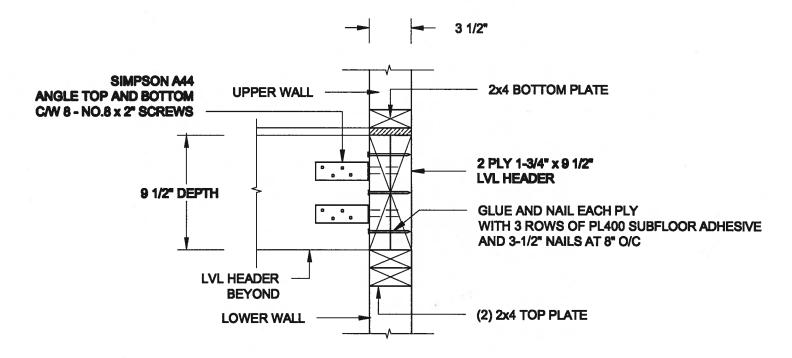

STAIR HEADER @ PARTYWALL SCALE: 1 1/2" = 1'-0"

Scale: Engineer's Sock QUAILE ENGINEERING LTD. DAYVIEW WILLINGTON HONER - GREEN VALLY ESPAIRS - SEMIS AS NOTED BRADFORD, ONTAXIO Dale: 38 Parkside Drive, UNIT 7 S. J. BOYD TYPICAL STRUCTURAL DETAILS Newmarket, ON JAN-00-6010 L3Y 8J9 T: 905-853-8547 Protect No.: DIGWIE Drawing No.: E: qualle.eng@rogers.com JAN 11,2018 SJB 17-194 **S2**

PASCING 40 AND TATIFFE EASY BY WELLINGTON GREEN VALLEY SEAS (17-194.0mg)

CONSTRUCTION NOTES (Unless otherwise noted) ALL CONSTRUCTION TO ADHERE TO THESE PLANS AND SPEC'S AND TO CONFORM TO THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE CODES AND AUTHORITIES HAVING JURISDICTION. THESE REQUIREMENTS ARE TO BE TAKEN AS MINIMUM SPECIFICATIONS. ONT. REG. 332/12-2012 OBC 1. ROOF CONSTRUCTION NO.210 (10.25kg/m2) ASPHALT SHINGLES, 10mm (3/8") PLYWOOD SHEATHING WITH "H" CLIPS, APPROVED WOOD TRUSSES @ 600mm (24") O.C. MAX, APPROVED EAVES PROTECTION TO EXTEND 900mm (24") O.C. MAX. APPROVED EAVES PROTECTION TO EXTEND 900mm (12") BEYOND INNER FACE OF EXTERIOR WALL. (EAVES PROTECTION NOT REQ'D FOR ROOF SLOPES 8:12 OR GREATER) 38x69 (2"x4") TRUSS BRACING @ 1830mm (6"0") O.C. AT BOTTOM CHORD. PREFIN. ALUM. EAVESTROUGH, FASCIA, RPAL & VENTED SOFFIT. PROVIDE ICE & WATER SHIELD TO ALL ROOF/WALL SURFACES SUSCEPTIBLE TO ICE DAMMING. ROOF SHEATHING TO BE FASTENED 150 (6") C/C ALONG EDGES & INTERMEDIATE SUPPORTS WHEN TRUSSES SPACED GREATER HAD A (12") ATIO CENTUR ATOM 1:300 OE INSULATED CENTUR ATOM.

AREA WITH MIN. 25% AT EAVES & MIN. 25% AT RIDGE (OBC 9.19.1.2.) FRAME WALL CONSTRUCTION (2"x6") (SB-12-TABLE 3.1.1.2.A)
SIDING AS PER ELEV.. 19x38 (1"x2") VERTICAL WOOD FURRING.
CONTIN. SHEATHING MEMBRANE, 9.5mm (3/6") EXT. TYPE SHEATHING,
38x140 (2"x") STUDS © 400mm (16") O.C., RSI 3.87 (R22) INSULATION
AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER,
13mm (1/2") INT. DRYWALL FINISH. SIDING TO BE MIN. 200mm (8") ABOVE FINISH GRADE, REFER TO OBC SB-12, CHAPTER 3 FOR ADDITIONAL THERMAL INSULATION REQUIREMENTS.

THAN 406 (16"), ATTIC VENTILATION 1:300 OF INSULATED CEILING

2A RESERVED

(2B) FRAME WALL CONSTRUCTION (2"x4")— GARAGE WALLS SIDING AS PER ELEV. 19x38 (1"x2") VERTICAL WOOD FURRING, CONTIN. SHEATHING MEMBRANE, 9.5mm (3/8") EXT. TYPE SHEATHING, 38x89 (2"x4") STUDS @ 400mm (16") O.C. (MAX. HEIGHT 3000mm (9'-10"), WITH APPR, DIAGONAL WALL BRACING, SIDING TO BE MIN.

(2C) RESERVED

STUCCO WALL CONSTRUCTION (2"x4") —GARAGE WALLS STUCCO CLADDING SYSTEM CONFORMING TO O.B.C. 9.27.1.1.(2) & 9.28 THAT EMPLOY A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 25mm (1") MIN. EXPANDED OR EXTRUDED RIGID POLYSTYRENE ON APPROVED AIR/MOISTURE BARRIER ON 13mm (1/2") EXT, TYPE SHEATHING ON 38x89 (2"x4") STUDS @ 400 (16") O.C., STUCCO TO BE MIN. 200 (8") ABOVE FINISH GRADE.

WALLS ADJACENT TO ATTIC SPACE — NO CLADDING 9.5mm (3/8") EXT. TYPE SHEATHING, 38x140 (2'x6") STUDS @ 400mm (1/6") O.C., RSI 3.87 (R22) INSULATION AND APPR. VAPOUR BARRIER AND APPR. CONTIN, AIR BARRIER, 13mm (1/2") INTERIOR DRYWALL FINISH. MID-HEIGHT BLOCKING REQ'D. IF NO SHEATHING APPLIED. REFER TO OBC SB-12, CHAPTER 3 FOR ADDITIONAL THERMAL SULATION REQUIREMENTS.

BRICK VENEER CONSTRUCTION (2"x6") (S8-12-TABLE 3.1.1.2.A) 90mm (4") FACE BRICK, 25mm (1") AIR SPACE, 22x180x0.76mm (7/8"x7"x0.03") GALV. METAL TIES @ 400mm (16") O.C. HORIZONTAL (7/84/7X0.03") GALV. METAL TIES & 400mm (16") O.C. HORIZONTAL
600mm (24") O.C. VERTICAL APPROVED SHEATHING PAPER, 9.5mm
(3/8") EXT. TYPE SHEATHING, 38x 140 (2"x6") STUDS & 400mm (16")
O.C., RSI 3.87 (R22) INSULATION & APPR. VAPOUR BARRIER WITH
APPR. CONTIN. AIR BARRIER. 13mm (1/2") INTERIOR DRYWALL FINISH.
PROVIDE WEEP HOLES & 800mm (32") O.C. BOTTOM COURSE AND
OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm (6")
BEHIND BUILDING PAPER, REFER TO OBC SB-12, CHAPTER 3 FOR
ADDITIONAL THERMAL INSULITATION BEQUIPERABLY. ADDITIONAL THERMAL INSULATION REQUIREMENTS BRICK TO BE MIN. 150mm (6") ABOVE FINISH GRADE

(3A.) RESERVED



BRICK VENEER CONSTRUCTION (2"x4")— GARAGE WALLS
90mm (4") FACE BRICK, 25mm (1") AIR SPACE, 22x180x0.76mm
(7/8'x7'x0.03") GALV. METAL IESE & 400mm (16") O.C. HORIZONTAL
600mm (24") O.C. VERTICAL APPR. SHEATHING PAPER, 9.5mm (3/8")
EXT. TYPE SHEATHING, 38x89 (2"x4") STUDS @ 400mm (16") O.C. (MAX.
HEIGHT 3000mm 9'-10") WITH APPR. DIAGONAL WALL BRACKING.
PROVIDE WEEP HOLES @ 800mm (32") O.C. BOTTOM COURSE AND
OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm (6")
BEHIND BUILDING PAPER.
BRICK VENEER CONSTRUCTION (6") ABOVE FINISH GRADE BRICK TO BE MIN. 150mm (6") ABOVE FINISH GRADE,

STUCCO WALL CONSTRUCTION (2"x6") (SB-12-TABLE 3.1.1.2A)
STUCCO CLADDING SYSTEM CONFORMING TO O.B.C., 9.27.1.1.(2) &
9.28 THAT EMPLOYS A MINIMUM 10mm AIR SPACE BEHIND THE
CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED
PER MANUFACTURERS SPECIFICATIONS OVER 25mm (1") MIN. EXTRUDED OR EXPANDED RIGID POLYSTYRENE ON APPR. CONTIN. AIR/MOISTURE BARRIER ON 13mm (1/2") EXT. TYPE SHEATHING ON 38x140 (2"x6") STUDS @ 400mm (16") O.C., RSI 3.87 (R22) INSULATION, APPROVED VAPOUR BARRIER, 13mm (1/2") GYPSUM WALLBOARD INTERIOR FINISH, REFER TO OBC 38-12, CHAPTER 3 FOR ADDITIONAL THERMAL INSULATION REQUIREMENTS, STUCCO TO BE MIN, 200 (8") ABOVE FINISH GRADE.

INTERIOR STUD PARTITIONS
FOR BEARING PARTITIONS 38x89 (2'x4") @ 400mm (16") O.C. FOR 2
STOREYS AND 300mm (12") O.C. FOR 3 STOREYS, NON-BEARING
PARTITIONS 38x89 (2'x4") @ 600mm (24") O.C. PROVIDE 38x89 (2'x4")
BOTTOM PLATE AND 2/38x89 (2/2'x4") TOP PLATE. 13mm [1/2") INT. DRYWALL BOTH SIDES OF STUDS, PROVIDE 38x140 (2'x6") STUDS/PLATES

FOUNDATION WALL/FOOTINGS: (9.15.3, 9.15.4, 9.13.2, 9.14.2.1,(2))
250mm (10") POURED CONC. FDI'N. WALL 30MPG (4350psi) WITH
BITUMENOUS DAMPPROOFING AND DRAINAGE LAYER. DRAINAGE
LAYER REQ'D. WHEN BASEMENT INSUL. EXTENDS 900 (2'-11") BELOW FIN. GRADE, DRAINAGE LAYER IS NOT REQ'D. WHEN FOTH, WALL IS WATERPROOFED, MAXIMUM POUR HEIGHT 2820 [9"-3"] ON 566x155 [22"x6"] CONTINUOUS KEYED CONC. FTG. BRACE FDTN. WALL PRIOR TO BACKFILLING. ALL FOOTINGS SHALL REST ON NATURAL UNDISTURBED SOIL OR COMPACTED ENGINEERED FILL, WITH MIN.

BEARING CAPACITY OF 150kPg OR GREATER. IF SOIL BEARING DOES

NOT MEET MINIMUM CAPACITY, ENGINEERED FOOTINGS ARE

REQUIRED.

-SEE OBC 9.15.3 -MAXIMUM FLOOR LIVE LOAD OF 2.4kPa. (50psf.) PER FLOOR, AND MAX LENGTH OF SUPPORTED FLOOR JOISTS IS 4 9m (16'-)" REFER TO SOILS REPORT FOR SOIL CONDITIONS AND BEARING

STRIP FOOTING SUPPORTING EXTERIOR WALLS (FOR W.O.B.)
-ASSUMING MASONRY VENEER CONSTRUCTION, MAX. FLOOR LIVE LOAD OF 2.4kPg. (50psf.) PER FLOOR, AND MAX, LENGTH OF RTED FLOOR JOISTS IS 4.9m (16'-1"). THE STRIP FOOTING SIZE IS AS FOLLOWS: 2 STOREY WITH WALK-OUT BASEMENT

545x175 (22'x7") FOUNDATION DRAINAGE OBC. 9.14.2. & 9.14.3.
100mm (4") DIA. FOUNDATION DRAINAGE TILE 150mm (6") CRUSHED
STONE OVER AND AROUND DRAINAGE TILES.

BASEMENT SLAB ORC. 9.3.1.8.(1)(b). 9.16.4.5.(1). 9.25.3.3.(15)
80mm (3")MIN. 25MPa (3600psi) CONC. SLAB ON 100mm (4")
COARSE GRANULAR FILL, OR 20MPa, (3000psi) CONC. WITH
DAMPPROOFING BELOW SLAB. UNDER SLAB INSULATION PER SB-12. ALL SLAB JOINTS & PENETRATIONS TO BE CAULKED.

EXPOSED FLOOR TO EXTERIOR (SB-12-TABLE 3.1.1.2A)
PROVIDE RSI 5.46 (R31) INSULATION, APPROVED VAPOUR BARRIER AND CONTINUOUS AIR BARRIER, FINISHED SOFFIT.

ATTIC INSULATION (SB-12-TABLE 3.1.1.2A) (SB-12-3.1.1.8)
RSI 10.56 (R60) BLOWN IN ROOF INSULATION AND APPROVED
VAPOUR BARRIER. 16mm (5/8") INI. DRYWALL FINISH OR APPROVED
EQUAL. RSI 3.52 (R20) MIN. ABOVE INNER SURFACE OF EXTERIOR WALL

(10) ALL STAIRS/EXTERIOR STAIRS -OBC. 9.8.-UNIFORM RISE -5mm (1/4") MAX BETWEEN ADJACENT TREADS OR LANDINGS -10mm (1/2") MAX BETWEEN TALLEST & SHORTEST RISE IN FLIGHT

= 200 (7-7/8") = 210 (8-1/4") = 235 (9-1/4") MIN. RUN MIN. TREAD = 25 (1") = 1950 (6'-5") MAX. NOSING MIN. HEADROOM RAIL @ LANDING RAIL @ STAIR = 900 (2'-11") = 865 (2'-10") to 965 (3'-2") MIN. STAIR WIDTH = 860 (2'-10")

MAX. RISE

FOR CURVED STAIRS MIN. RUN MIN. AVG. RUN

HANDRAIL -- OBC. 9.8.7.—
FINISHED RALLING ON PICKETS SPACED MAXIMUM 100mm (4")
BETWEEN PICKETS. CLEARANCE BETWEEN HANDRAIL AND SURFACE

17. DE 50 (2"I MIN. HANDRAILS TO BE CONTINUOUS

37. EXCEPT FOR NEWEL POST AT CHANGES OF DIRECTION

= 200 (8")

INTERIOR GUARDS -OBC. 9.8.8.-INTERIOR GUARDS: 900mm (2'-11") MIN. HIGH
EXTERIOR GUARDS — OBC. 9.8.8.
900mm (36") HIGH GUARD WHERE DISTANCE FROM PORCH TO FIN.

GRADE IS LESS THAN 1800mm (71"). 1070mm (42") HIGH GUARD IS REQUIRED WHERE DISTANCE EXCEEDS 1800mm (71").

SILL PLATE — OBC. 9.23.7.

38x89 (2'x4") SILL PLATE WITH 13mm (1/2") DIA. ANCHOR BOLTS

200mm (8") LONG, EMBEDDED MIN. 100mm (4") INTO CONC. @

2400mm (7"-10") O.C., CAULKING OR 25 (1") MIN. MINERAL WOOL

BETWEEN PLATE AND TOP OF FDTN. WALL. USE NON-SHRINK GROUT TO LEVEL SILL PLATE WHEN REQUIRED.

BASEMENT INSULATION (SB-12-3.1.1.7), 9.25.2.3, 9.13.2.6)
FOUNDATION WALLS ENCLOSING HEATED SPACE SHALL BE
INSULATED FROM THE UNDERSIDE OF THE SUBFLOOR TO NOT MORE
THAN 200mm (8") ABOVE THE FINISHED FLOOR & NO CLOSER THAN
50mm (2") OF THE BASEMENT SLAB, RSI3.52ci (R20ci) BLANKET INSULATION TO HAVE APPROVED VAPOUR BARRIER, RECOMMEND DAMPPROOF WITH BUILDING PAPER BETWEEN THE FOUNDATION WALL AND INSULATION UP TO GRADE LEVEL NOTE: FULL HEIGHT INSULATION AT COLD CELLAR WALLS. AIR BARRIER TO BE SEALED TO FOUNDATION WALL WITH CAULKING. CONTINUOUS INSULATION (ci) IS NOT TO BE INTERRUPTED BY FRAMING.

BEARING STUD PARTITION
38x89 (2"x4") STUDS @ 400mm (16") O.C. 38x89 (2"x4") SILL PLATE ON DAMPPROOFING MATERIAL, 13mm (1/2") DIA. ANCHOR BOLTS 200mm (8") LONG, EMBEDDED MIN. 100mm (4") INTO CONC. @ 2400mm (7"-10") O.C. 100mm (4") HIGH CONC. CURB ON 350x155 (14"x6") CONC. FOOTING. ADD HORIZ. BLOCKING AT MID-HEIGHT IF WALL IS UNFINISHED.

STEEL BASEMENT COLUMN (SEE O.B.C. 9.15.3.3) 89mm(3-1/2") DIA x 3.0mm(0.118) SINGLE WALL TUBE TYPE 2 ADJUSTABLE STL. COL. W/ MIN. CAPACITY OF 71.2kn (16,000lbs.) AT A MAX. EXTENSION OF 2318mm (7"-7 1/2") CONFORMING TO CAN/CGSB-7.2-94. AND WITH 150x150x9.5 (6"x6"x3/8") STL. PLATE TOP & BOTTOM. 870x870x410 (34*x34*x16*) CONC. FOOTING ON UNDISTURBED SOIL OR ENGINEERED FILL CAPABLE OF SUSTAINING PRESSURE OF 150 Kpg. MINIMUM AND AS PER SOILS REPORT.

STEEL BASEMENT COLUMN (SEE O.B.C. 9.15.3.3)
89mm(3-1/27) DIA x 4.78mm(.188) FIXED STL. COL. WITH 150x150x9.5
(5/x5/x3/87) STL. TOP. & BOTTOM PLATE ON 1070x1070x400
(4/2/x4/2/x18"). CONC. FOOTING ON UNDISTURBED SOIL OR ENGINEEREÓ FILL CAPABLE OF SUSTAINING A PRESSURE OF 150 Kpa.

STEEL COLUMN 90mm(3-1/2") DIA x 4.78mm(.188) NON-ADJUSTABLE STL, COL, TO BE ON 150x150x9.5 (6"x6"x3/8") STEEL TOP PLATE, & BOTTOM PLATE. BASE PLATE 120x250x12.5 (4 1/2'x10'x1/2") WITH 2-12mm DtA. > 300mm LONG x50mm HOOK ANCHORS (2-1/2'x12'x2") FIELD WELD COL. TO BASE PLATE.

BEAM POCKET OR 300x150 (12'x6") POURED CONC. NIB WALLS. MIN. BEARING 90mm (3-1/2")

19x64 (1"x3") CONTINUOUS WOOD STRAPPING BOTH SIDES OF STEEL

GARAGE SLAB 100mm (4") 32MPa (4640psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT ON OPT. 100 (4") COARSE GRANULAR FILL WITH COMPACTED SUB-BASE OR COMPACTED NATIVE FILL.

SLOPE TO FRONT.

19

19

13mm (1/2*) GYPSUM BOARD ON WALL AND CEILING BETWEEN HOUSE AND GARAGE. TAPE AND SEAL ALL JOINTS AIRTIGHT PER O.B.C. 9.10.9.16. WALLS (R22), CEILINGS (R31). REFER TO SB-12, TABLE 3.1.1.2.A. FOR REQUIRED THERMAL INSULATION.

DOOR AND FRAME GASPROOFED. DOOR EQUIPPED WITH SELF CLOSING DEVICE AND WEATHERSTRIPPING PER OBC 9.10.13.15.

EXTERIOR STEPPRECAST CONCRETE STEP OR WOOD STEP WHERE NOT EXPOSED TO WEATHER. MAX. RISE 200mm (7-7/8"] MIN. TREAD 250mm (9-1/2"). SEE OBC. 9.8.9.2., 9.8.9.3. & 9.8.10.

DRYER EXHAUST (08C-6.2.3.6.(7) & 6.2.4.11.)
CAPPED DRYER EXHAUST VENTED TO EXTERIOR. (USE 100mm (4") DIA. SMOOTH WALL VENT PIPE)

INSULATED ATTIC ACCESS (OBC-9.19.2.1. & SB12-3.1.1.8)
ATTIC ACCESS HATCH WITH MIN. DIMENSION OF 545x610mm (21 1/2'x24") & A MIN. AREA OF 0.32 SQ.M. (3.44 SQ.FT.) WITH WEATHERSTRIPPING. RSI 3.52 (R20) RIGID INSUL. BACKING.

FIREPLACE CHIMNEYS OBC. 9.21.

TOP OF FIREPLACE CHIMNEY SHALL BE 915mm (3'-0") ABOVE THE HIGHEST POINT AT WHICH IT COMES IN CONTACT WITH THE ROOF AND 610mm (2-0") ABOVE THE ROOF SURFACE WITHIN A HORIZ. DISTANCE OF 3050mm (10"-0") FROM THE CHIMNEY.

LINEN CLOSET, 4 SHELVES MIN. 350mm (14") DEEP.

MECHANICAL EXHAUST FAN, VENTED TO EXTERIOR AS REQUIRED BY OBC. 9.32.3.5. & 9.32.3.10.

STEEL BEARING PLATE FOR MASONRY WALLS
280x280x16 (11"x11"x5/8") STL. PLATE FOR STL BEAMS AND
280x280x12 (11"x11"x1/2") STL. PLATE FOR WOOD BEAMS BEARING ON CONC. BLOCK PARTYWALL, ANCHORED WITH 2-19mm (3/4") x 200mm (8") LONG GALV. ANCHORS WITHIN SOLID BLOCK COURSE. LEVEL WITH NON-SHRINK GROUT.

OR
SOLID WOOD BEARING FOR WOOD STUD WALLS
SOLID BEARING TO BE AT LEAST AS WIDE AS THE SUPPORTED MEMBER, SOLID WOOD BEARING COMPRISED OF BUILT-UP WOOD STUDS TO BE CONSTRUCTED IN ACCORDANCE WITH OBC

RESERVED

BEARING WOOD POST (BASEMENT) (OBC 9.17.4.)
3-39x140 (3-2'x6") BUILT-UP-POST ON METAL BASE SHOE ANCHORED TO CONC. WITH 12.7 DIA. BOLT, 610x610x300 (24"x24"x12") CONC.

MIN. HORIZ. STEP = 600mm (24") MAX. VERT. STEP = 600mm (24")

SLAB ON GRADE
MIN. 100mm (4") CONCRETE SLAB ON GRADE ON 100mm (4")
COARSE GRANULAR FILL REINFORCED WITH 6x6-W2.9xW2.9 MESH
PLACED NEAR MID-DEPIH OF SLAB. CONC. STRENGTH 32 MPG (4640 psi) WITH 5-8% AIR ENTRAINMENT ON COMPACTED SUB-GRADE, WHERE REQUIRED, REFER TO OBC SB-12, TABLE

3.1.1.2.A. FOR REQUIRED MINIMUM INSULATION UNDER SLAB.

DIRECT VENTING GAS FURNACE/ H.W.T VENT DIRECT VENT FURNACE TERMINAL MIN. 900mm (36") FROM A GAS REGULATOR. MIN. 300mm (12") ABOVE FIN. GRADE, FROM ALL OPENINGS, EXHAUST AND INTAKE VENTS. HRV INTAKE TO BE A MIN. OF 1830mm (6-0") FROM ALL EXHAUST TERMINALS. REFER TO GAS

DIRECT VENTING GAS FIREPLACE VENT
DIRECT VENT GAS FIREPLACE. VENT TO BE A MINIMUM 300mm (12")
FROM ANY OPENING AND ABOVE FIN. GRADE. REFER TO GAS UTILIZATION CODE.

SUBFLOOR. JOIST STRAPPING AND BRIDGING
16mm (5/8") T & G SUBFLOOR ON WOOD FLOOR JOISTS. FOR
CERAMIC TILE APPLICATION (* SEE OBC 9.30.6. *) 6mm (1/4") PANEL TYPE UNDERLAY UNDER RESILIENT & PARQUET FLOORING. (* SEE FLOOR JOISTS WITH SPANS OVER 2100mm (6'-11") TO BE BRIDGED WITH 38x38 (2'x2") CROSS BRACING OR SOLID BLOCKING @ 2100mm (6'-1)"] O.C. MAX. AND WHERE SPECIFIED BY JOIST TABLES A-1 OR A-2 STRAPPING SHALL BE 19x64 (1'x3") @ 2100mm (6'-11") O.C. UNLESS A PANEL TYPE CEILING FINISH IS APPLIED. EXPOSED BUILDING FACE OBC. 9.10.15. & SB-2-2.3.5.(2) EXTERIOR WALLS TO HAVE A FIRE RESISTANCE RATING OF NOT EXTENSIVE AS MIN. WHERE LIMITING DISTANCE (LD) IS LESS THAN 1.2M (3-11"). WHERE THE LD IS LESS THAN 400mm (1-11") THE EXPOSING FACE SHALL BE CLAD IN NON-COMBUSTIBLE MATERIAL. SEE ELEVATIONS FOR ADDITIONAL NOTES. OFFENDING GARAGE WALLS INCLUDED.

COLD CELLAR PORCH SLAB (OBC 9.39.) FOR MAX. 2500mm (8-2") PORCH DEPTH (SHORTEST DIM.), 125mm (5") 32MPD (4640ps) CONC. SLAB WITH 5-8% AIR ENTRAINMENT. REINF. WITH 10M BARS @ 200mm (7 7/8") O.C. EACH WAY IN BOTTOM THIRD OF SLAB, MIN. 30mm (1 1/4") COVER, 600x600 (23 5/8"x23 5/8") 10M DOWELS @ 600mm (23 5/8") O.C., ANCHORED IN PERIMETER FDTN. WALLS, SLOPE SLAB MIN. 1.0% FROM HOUSE WALL, SLAB TO HAVE MIN. 75mm (3") BEARING ON FOTN, WALLS, PROVIDE (L7) LINTEL OVER CELLAR DOOR WITH 100mm (4") END BEARING.
THE FDTN. WALL SHALL NOT BE REDUCED TO LESS THAN 90mm

(3-1/2") THICK TO A MAX, DEPTH OF 600mm (24") AND SHALL BE TIED TO THE FACING MATERIAL WITH METAL TIES SPACED 200mm (8") O.C. VERTICALLY AND 900mm (36") O.C. HORIZONTALLY. FILL SPACE BETWEEN WALL AND FACING SOLID WITH MORTAR.

CONVENTIONAL ROOF FRAMING (2.0Kpg. SNOW LOAD)
38x140 (2'x6") RAFTERS @ 400mm (16"O.C.) FOR MAX 11'-7"
SPAN, 38x184 (2'x8") RIDGE BOARD, 38x89 (2'x4") COLLAR TIES AT MIDSPANS, CEILING JOISTS TO BE 38x89 (2'x4") @ 400mm (16") O.C. FOR MAX. 2830mm (9'-3") SPAN & 38x140 (2'x6") @ 400 (16") O.C. FOR MAX. 4450mm (14'-7") SPAN. RAFTERS FOR BUILT-UP ROOF TO BE 38x89 (2'x4") @ 600mm (24") O.C. WITH A 38x89 (2'x4") CENTRE POST TO THE TRUSS BELOW, LATERALLY BRACED @ 1800mm (6'-0") O.C. VERTICALLY.

GENERAL NOTES

WINDOWS: 1) MINIMUM BEDROOM WINDOW —OBC. 9.9.10.1.

AT LEAST ONE BEDROOM WINDOW ON A GIVEN FLOC
HAVE MIN. 0.35m2 UNOBSTRUCTED GLAZED OR OPEN. AREA WITH MIN. CLEAR WIDTH OF 380 mm (1'-3")

2) MINDOW GLARDS — OBC. 9.8.6.1,16).
A GUARD IS REQUIRED WHERE THE TOP OF THE WINDOW SILL IS LOCATED LESS THAN 480mm (1'-7') ABOVE FIN. FLOOR AND THE DISTANCE FROM THE FIN. FLOOR TO THE ADJACENT GRADE IS GREATER THAN 1800mm (5-11")

3) EXTERIOR WINDOWS SHALL COMPLY WITH OBC DIV.-B 9.7.3. & SB12-3.1.1.9

GENERAL: 1) MECHANICAL VENTILATION IS REQUIRED TO COMPLY WITH OBC-DIV. B, 6.2.2. SEE MECHANICAL DRAWINGS.

ALL DOWNSPOUTS TO DRAIN AWAY FROM THE BUILDING AS PEI OBC 9.26.18.2. & 5.6.2.2.(3) AND MUNICIPAL STANDARDS. 3) ALL WINDOW WELLS TO DRAIN TO FOOTING LEVEL PER OBC 9.14.6.3. CHECK WITH THE LOCAL AUTHORITY.

STUD WALL REINFORCEMENT FOR FUTURE GRAB BARS IN MAIN BATHROOM
REINFORCEMENT OF STUD WALLS SHALL BE INSTALLED REINFORCEMENT OF SIDU WALLS SHALL BE INSTALLED ADJACENT TO WATER CLOSETS AND SHOWER OR BATHTUB IN MAIN BATHROOM. REFER TO OBC. 9.5.2.3, 3.8.3.8.[1][d] & 3.8.3.13.[1][f]. SEE DETAIL.
ALL EXTERIOR DOORS TO COMPLY WITH THERMAL RESISTANCE AS STATED IN O.B.C. \$8-12-3.1.1.9.

ALL AIR BARRIER SYSTEMS ARE REQUIRED TO COMPLY WITH O.B.C. DIV.-B 9.25.3.

ALL LUMBER SHALL BE SPRUCE NO.2 GRADE, UNLESS NOTED OTHERWISE. LUMBER: 1)

2) STUDS SHALL BE STUD GRADE SPRUCE, UNLESS NOTED OTHERWISE.

LUMBER EXPOSED TO THE EXTERIOR TO BE SPRUCE No.2 GRADE PRESSURE TREATED OR CEDAR, UNLESS NOTED OTHERWISE.

ALL LAMINATED VENEER LUMBER (L.V.L.) BEAMS, GIRDER TRUSSES, AND METAL HANGER CONNECTIONS SUPPORTING ROOF RAMING TO BE DESIGNED & CERTIFIED BY TRUSS MANUFACTURER.

LVL BEAMS SHALL BE 2.0E -2950Fb MIN., NAIL EACH PLY OF LVL LVL BEAMS SHALL BE 2.10: -2950FD MIN., NAIL EACH PLY OF LV WITH B97mm [3 1/27] LONG COMMON WITER NAILS @ 300mm [7 1/27] O.C. STAGGERED IN 2 ROWS FOR 184, 240 & 300mm [7 1/47,9 1/27, 11 7/87] DEPTHS AND STAGGERED IN 3 ROWS FOR GREATER DEPTHS AND FOR 4 PLY MEMBERS ADD 13mm [1/27] DIA. GALVANIZED BOLTS BOLTED AT MID-DEPTH OF BEAM @ 915mm [1/27]

DIA. GALVANIZED BOLTS BOLTED AT MID-DEPTH OF BEAM @ 915mm (3°70) O.C.

PROVIDE FACE MOUNT BEAM HANGERS TYPE "SCL"
MANUFACTURED 8'Y SIMP'SON STRONG-THE OR EQUAL
FOR ALL LIVL BEAM TO BEAM CONNECTIONS UNLESS
OTHERWISE NOTED. REFER TO ENG. FLOOR LAYOUTS.
JOIST HANGERS: PROVIDE METAL HANGERS FOR ALL JOISTS
AND BUILT-UP WOOD MEMBERS INTERSECTING FLUSH BUILT-UP
WOOD MEMBERS.
WOOD FRAMING NOT TREATED WITH A WOOD PRESERVATIVE.
IN CONTACT WITH CONCRETE, SHALL BE SEPARATED FROM THE
CONCRETE BY AT LEAST 2 mil. POLYETHYLENE FILM, NO. 50
[45/bis.] ROLL ROOFING OR OTHER DAMPPROOFING MATERIAL,
EXCEPT WHERE THE WOOD MEMBER S AT LEAST 150mm (67)
ABOVE THE GROUND.

ABOVE IHE GKOUND.
STRUCTURAL STEEL SHALL CONFORM TO CAN/CSA-G40-21
GRADE 300M. HOLLOW STRUCTURAL SECTIONS SHALL
CONFORM TO CSA-G40.21 GRADE 350W "STRUCTURAL
QUALITY STEEL". OBC. B-9.23.4.3.
RENPORCING STEEL SHALL CONFORM TO CSA-G30-18M
GRADE 400R.

GRADE 400K.

ALL STUCCO WALLS TO HAVE A MINIMUM 10mm AIR SPACE
BEHIND THE CLADDING WITH POSITIVE ORAINAGE TO THE
EXTERIOR. THE EXTERIOR SHEATHING MUST NOT BE GYPSUM
BASED. ALL STUCCO TO BE INSTALLED AS PER MANUFACTURERS STUCCO: 1)

EXHAUST FAN TO EXTERIOR

HEAVY DUTY OUTLET (220 volt)

LIGHT FIXTURE (CEILING MOUNTED)

PRESSURE TREATED

GIRDER TRUSS BY ROOF TRUSS MANUF

■ 4

LIGHT FIXTURE (WALL MOUNTED)

LEGEND 0 9 CLASS 'B' VENT OUPLEX OUTLET (HEIGHT A.F.F) DUPLEX OUTLET (12" ABOVE SURFACE) 0= WEATHERPROOF DUPLEX OUTLET POT LIGHT

LIGHT FIXTURE (PULL CHAIN)

SPECIFICATIONS.

GFI DUPLEX OUTLET (HEIGHT A.F.F)

SWITCH HOSE BIB (NON-FREEZE) FLOOR DRAIN P.T.

SINGLE JOIST DOUBLE JOIST TRIPLE JOIST

DJ TJ

LAMINATED VENEER LUMBER

POINT LOAD FROM ABOVE CA. CURVED ARCH FLAT ARCH

MEDICINE CABINET (RECESSED) DOUBLE VOLUME
WALL SEE NOTE 39
CONCRETE
BLOCK WAL

SOLID WOOD BEARING (SPRUCE No. 2).
SOLID BEARING TO BE AS WIDE AS
SUPPORTED MEMBER OR AS DIRECTED BY
STRUCTURAL ENGINEER.
SOLID BEARING TO BE MINIMUM 2 PIECES. SOLID WOOD BEARING TO MATCH FROM ABOVE

ELECTRIC VEHICLE CHARGING SYSTEM (EVCS)
ROUGH-IN FOR FUTURE ELECTRIC VEHICLE SUPPLY EQUIPM

(CHARGING SYSTEM) TO BE INSTALLED. ROUGH-IN SHALL INCLUDE: A minimum 200 amp Panelboard Conduit that is not less than 1 1/16" (27mm) trade size

A square 4 11/16" (119mm) trade size electrical outlet Furnerycofed Electrical outlet boy to be installed in the Garage or carport or adjacent to driv REFER TO 2012 OBC. 9.34.4.

SOIL GAS/ RADON CONTROL (OBC 9.1.1.7. & 9.13.4.) PROVIDE CONSTRUCTION TO PREVENT LEAKAGE OF SOIL GAS INTO THE BUILDING IF REQUIRED. CONTRACTOR MUST VERIFY ALL DIMENSIONS ON

AND REPORT ANY DISCREPANCY TO VA3 DESIGN BEFORE PROCEEDING WITH THE WORK, ALL DRAWINGS AND SPECIFICATIONS ARE INSTRUMENTS OF SERVICE AND THE PROPERTY OF VA3 DESIGN WHICH IF REQUESTED, MUST BE RETURNED AT THE COMPLETION OF THE WORK, ALL DRAWINGS TO BE USED FOR CONSTRUCTION ONLY AFTER BUILDING PERMIT HAS BEEN ISSUED.

TWO STOREY VOLUME SPACES

-FOR A MAXIMUM 5490 mm (18-0") HEIGHT AND MAXIMUM SUPPORTED ROOF TRUSS LENGTH OF 6.0m, PROVIDE 2-38x140 (2-2'x6") SPR.#2 CONTIN, STUDS @ 300mm (12") 2-38x140 (2-2x6") SPR.#2 CONTIN. STUDS @ 300mm (12")
O.C. (TRIPLE UP AT EVERY THIRD DOUBLE STUD FOR BRICK
WALLS) C/W 9.6 (3/8") THICK EXT. PLYWOOD SHEATHING,
PROVIDE SOUID WOOD BLOCKING BETWEEN WOOD STUDS
@ 1220 mm (4-0") O.C. VERTICALLY. -FOR WALLS WITH
HORIZ. DISTANCES NOT EXCEEDING 2900 mm (9'-6"),
PROVIDE 38x140 (2'x6") STUDS @ 400 (16") O.C. WITH
CONTINUOUS 2-38x140 (2'x5") TOP PLATES + 1-38x140
[-2"2x4"] BOTTOM PLATE - AND MALLO E 3 28x141 (2 "2") (1-2"x6") BOTTOM PLATE & MINIMUM OF 3-38x184 (3-2"x8") CONT. HEADER AT GRND. CEILING LEVEL TOE-NAILED & GLUED AT TOP, BOTTOM PLATES AND HEADERS.

TYPICAL 1 HOUR RATED PARTY WALL.
REFER TO DETAILS FOR TYPE AND SPECIFICATIONS.

FOUNDATION WALL (W.O.D./W.O.B.) WHERE GRADE TO T/O BASEMENT SLAB EXCEEDS 1200mm (3'-11") A 250mm (10") WIDE FOUNDATION WALL IS

42. EXTERIOR WALLS FOR WALK-OUT CONDITIONS
THE EXTERIOR PRACEMENT STUD STUDS @ 400mm (16") o.c. OR 38x89 (2"x4") STUDS @ 300mm

DRAIN WATER HEAT RECOVERY UNIT (DWHR) PER SB12-3.1.1.12. A DRAIN WATER HEAT RECOVERY (DWHR)
UNIT SHALL BE INSTALLED IN EACH DWELLING UNIT TO RECEIVE
DRAIN WATER FROM ALL SHOWERS OR FROM AT LEAST TWO
SHOWERS WHERE THERE ARE TWO OR MORE SHOWERS IN THE
DWELLING UNIT. DOES NOT APPLY IF THERE ARE NO SHOWERS
OR NO STOREY BENEATH ANY OF THE SHOWERS.

♦ REVISED ONT. REG. 332/12-2012 OBC
Amendment O. Reg. 139/17 JUNE 19, 2017 WOOD LINTELS AND BUILT-UP WOOD BEAMS 2/38 x 184 (2/2" x 8") SPR.#2 3/38 x 184 (3/2" x 8") SPR.#2 4/38 x 184 (4/2" x 8") SPR.#2 5/38 x 184 (5/2" x 8") SPR.#2 2/38 x 235 (2/2" x 10") SPR.#2 3/38 x 235 (3/2" x 10") SPR.#2 4/38 x 235 (4/2" x 10") SPR.#2 2/38 x 286 (2/2" x 12") SPR.#2 3/38 x 286 (3/2" x 12") SPR.#2 4/38 x 286 (4/2" x 12") SPR.#2

LOOSE STEEL LINTELS 89 x 89 x 6.4L (3-1/2" x 3-1/2" x 1/4"L)
89 x 89 x 7.9L (3-1/2" x 3-1/2" x 5/16"L)
102 x 89 x 7.9L (4" x 3-1/2" x 5/16"L)
127 x 89 x 7.9L (5" x 3-1/2" x 5/16"L)
152 x 89 x 10.0L (6" x 3-1/2" x 3/8"L)
152 x 102 x 11.0L (6"x 4" x 7/16"L)
178 x 102 x 13.0L (7"x 4" x 1/2"L)

LAMINATED VENEER LUMBER (LVL) BEAMS

LVL1A 1-1 3/4"x7 1/4" (1-45x184)
LVL1 2-1 3/4"x7 1/4" (2-45x184)
LVL2 3-1 3/4"x7 1/4" (3-45x184)
LVL3 4-1 3/4"x7 1/4" (4-45x184)
LVL4A 1-1 3/4"x9 1/2" (1-45x240)
LVL4 2-1 3/4"x9 1/2" (3-45x240)
LVL5 3-1 3/4"x9 1/2" (3-45x240) 4-1 3/4"x9 1/2" (4-45x240) LVL8A 1-1 3/4"x11 7/8" (1-45x300) LVL6 2-1 3/4"x11 7/8" (2-45x300) LVL7 3-1 3/4"x11 7/8" (3-45x300) 4-1 3/4"x11 7/8" (4-45x300)

DOOR SCHEDULE EXTERIOR 815 x 2030 x 45 DOOR (2'-8" x 6'-8" x 1-3/4") INSULATED MIN. RSI 0.7 (R4) 1A EXTERIOR 865 x 2030 x 45 DOOR (2'-10" x 6'-8" x 1-3/4")

(2-10 x 0-5 x 1-3/4)

(B) EXTERIOR 915 x 2030 x 45 DOOR (3-0" x 6"-8" x 1-3/4")

(C) EXTERIOR 915 x 2435 x 45 DOOR (3"-0" x 8"-0" x 1-3/4")

(D) EXTERIOR 800 x 2435 x 45 DOOR (2"-10" x 6"-0" x 1-3/4")

(EXTERIOR 800 x 2435 x 45 DOOR (2"-10" x 6"-0" x 1-3/4")

(EXTERIOR 800 x 235 x 45 DOOR (2"-0" x 6"-6" x 1-3/8")

(C) EXTERIOR 815 x 2030 x 35 DOOR (2"-6" x 6"-6" x 1-3/8")

2A DOOR 815 x 2030 x 45

(2'-8' x 8'-8'' x 1-3/4'') 20

MN. RATED DOOR AND FRAME.
WITH APPROVED SELF CLOSING

| DEVICE | D

EXTERIOR 815 x 2438 x 45
DOOR (2'-6' x 8'-0' x 1-3/4') 20
MIN. RATED DOOR AND FRAME,
WITH APPROVED SELF CLOSING
DEWCE. 3. INTERIOR DOOR 760 x 2030 x 35 (2'-6" x 6'-8" x 1-3/8")

(3A) INTERIOR 710 x 2030 x 35 DOOR (2'-4" x 6'-8" x 1-3/8") INTERIOR 760 x 2438 x 35 DOOR (2'-6" x 8'-0" x 1-3/8") (3B)

INTERIOR 710 x 2438 x 35 DOOR (2'-4" x 8'-0" x 1-3/8") (30) INTERIOR 610 x 2030 x 35 DOOR (2'-0" x 6'-8" x 1-3/8") (4.) INTERIOR 660 x 2030 x 35 DOOR (2'-2" x 6'-8" x 1-3/8") (4A)

INTERIOR 880 x 2438 x 35 DOOR (2'-2" x 8'-0" x 1-3/8") (4C) INTERIOR 460 x 2030 x 35 DOOR (1'-6" x 6'-8" x 1-3/8") (5.) 6. DOOR 815 x 2030 x 45 DOOR (2'-8" x 6'-8" x 1-3/4") SOLID WOOD CORE

SMOKE ALARM (REFER TO OBC 9.10.19)

MECHANICAL SYMBOLS HEAT PIPE PLUMBING (** WARM AIR RETURN AIR DUCT PLUMBING (TOILET) PLUMBING (BATH, SINK, SHOWER)

PROVIDE 1 PER FLOOR, NEAR THE STAIRS CONNECTING THE FLOOR LEVEL AND ALSO 1 IN EACH BEDROOM NEAR HALL DOOR, ALARMS TO BE CONNECTED TO AN ELECTRICAL CIRCUIT AND INTERCONNECTED TO ACTIVATE ALL ALARMS IF 1 SOUNDS. BATTERY BACK-UP REQUIRED. SMOKE ALARMS TO INCORPORATE VISUAL SIGNALLING COMPONENT (9.10.19.3.(3)).

CARBON MONOXIDE ALARMS (OBC 9.33.4.)
WHERE A FUEL-BURNING APPLIANCE IS INSTALLED IN A DWELLING UNIT,
A CARBON MONOXIDE ALARM CONFORMING TO CAN./CSA-6.19 OR UL2034 SHALL BE INSTALLED ADJACENT TO EACH SLEEPING AREA CARBON MONOXIDE DETECTOR(S) SHALL BE PERMANENTLY WIRED SO THAT ITS ACTIVATION WILL ACTIVATE ALL CARBON MONOXIDE DETECTORS AND BE EQUIPPED WITH AN ALARM THAT IS AUDIBLE WITHIN BEDROOMS WHEN THE INTERVENING DOORS ARE CLOSED, REFER TO MANUFACTURER FOR ADDDITIONAL REQUIREMENTS.

REFER TO UNIT DRAWINGS OR PAGE CN-2 FOR SB-12 COMPLIANCE PACKAGE AT TO BE USED FOR THIS MODEL. The minimum thermal performance of building envelope and equipment shall conform to the selected package unless otherwise noted.

2018 VAS REFERENCE NU

16023

CONST NOTE

6 2 UPDATE TO 2018 JAN 11-18 RC 1 ISSUE FOR CLIENT REVIEW AUG 04-17 RC no. description date by

Bostiste Wellington Jno-Baptiste 2559

(* SEE OBC 9.23.9.4. *)

VÅ3 Design Inc. 42658 Contractor must verify all dimensions on th discrepancy to the Designer before proceed drawings and specifications are instruments and report any roceeding with the work. All ments of service and the property and the prope of the Designer which must be returned at the completion of the work.

Drawings are not to be scaled.

255 Consumers Rd Suite Toronto ON M2J 1R4 120 t 416.630.2255 f 416.630.4782 va3design.com


BAYVIEW WELLINGTON GREEN VALLEY EAST MAY 2016

BRADFORD

CONSTRUCTION NOTES 16023-CN-A1


NCHARD_ - H:\ARCHIVE\WORKING\2016\16023.BW\Units\CN NOTES\16023-CN-A1.dwg - Thu - Jon 11 2018 specifications, related documents and design are the copyright property of VAS DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VAS DESIGN's written

3/16" = 1'-0"

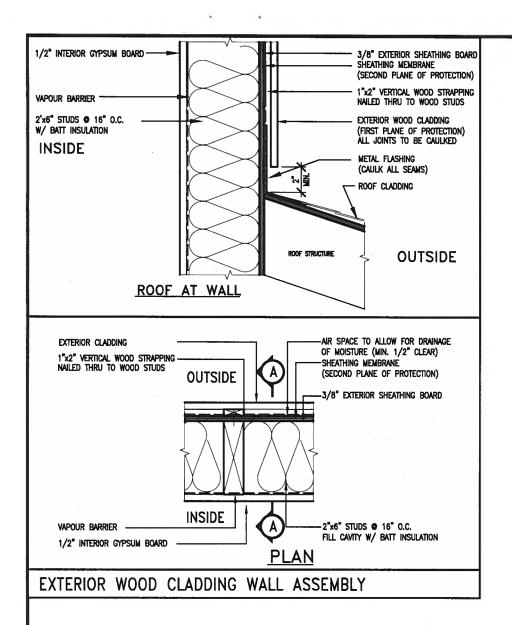


STUD WALL REINFORCEMENT FOR FUTURE GRAB BARS IN MAIN BATHROOM.
REINFORCEMENT OF STUD WALLS SHALL BE INSTALLED ADJACENT TO WATER CLOSETS AND SHOWER OR BATHTUB IN MAIN BATHROOM.
FUTURE GRAB BARS TO BE MOUNTED TO RESIST HORIZ. AND VERT. LOADS OF 1.3 KN (300 Ib)


REFER TO OBC. DN. B— 9.5.2.3. WATER CLOSET 3.8.3.8.(3)(a) & 3.8.3.8.(3)(c).. SHOWER 3.8.3.13.(2)(f).. BATHTUB & 3.8.3.13.(4)(c). AND DETAILS PROVIDED.

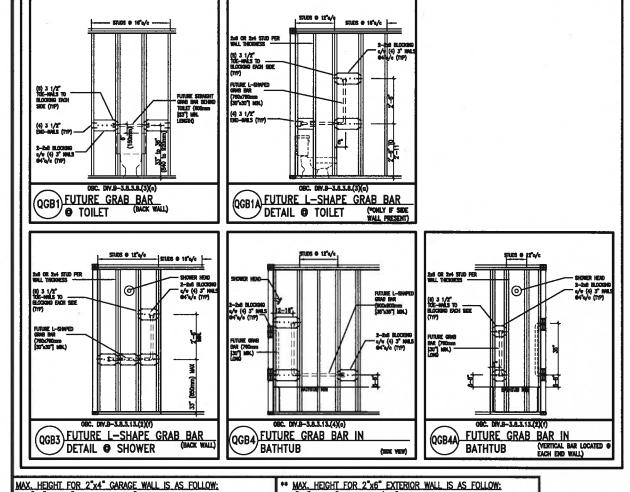







"CRIPPLE" DETAIL

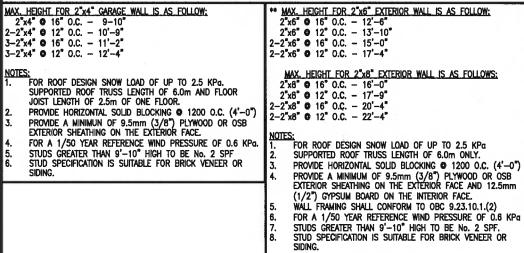

9 . 8 . 7 . 6 .		÷	The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. qualification information Wellination Jnc-Baptiste / JBoff 1976 25591	VAS	BAYV	EW	WELLINGTO	M	CONST	NOTE
5 . 4 .		H	name engistration information VA3 Design Inc. 42658	DESIGN	GREEN VALLEY E	AST		BRADFORD		project no. 16023
3 . 2 UPDATE TO 2018	JAN 11-1	RC	Contraction and walk all discussions as the lab and aread and	255 Consumers Rd Suite 120	MAY 2016			CONST	RUCTION NOTES	drawing no.
1 ISSUE FOR CLIENT REVIEW	AUG 04-1	RC	drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work.	Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782	RC	nacked by	3/16" = 1'-0"		file name 16023-CN-A1	CNZ
no. description	date	by	Drawings are not to be scaled.	va3design.com	RICHARD - H:\ARCHIVE\WORKIN	IC\2016\160	023.BW\Units\CN NOTES\16023-	-CN-A1.dwg - Thu -	Jan 11 2018 - 10:08 AM	

** STUD INFORMATION TAKEN FROM OBC TABLE A-30

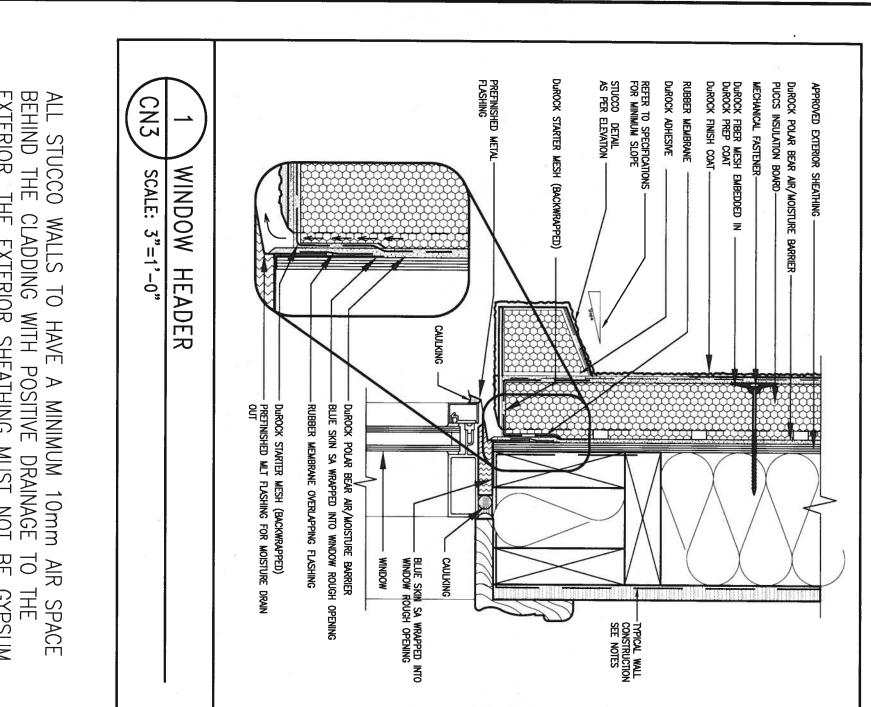

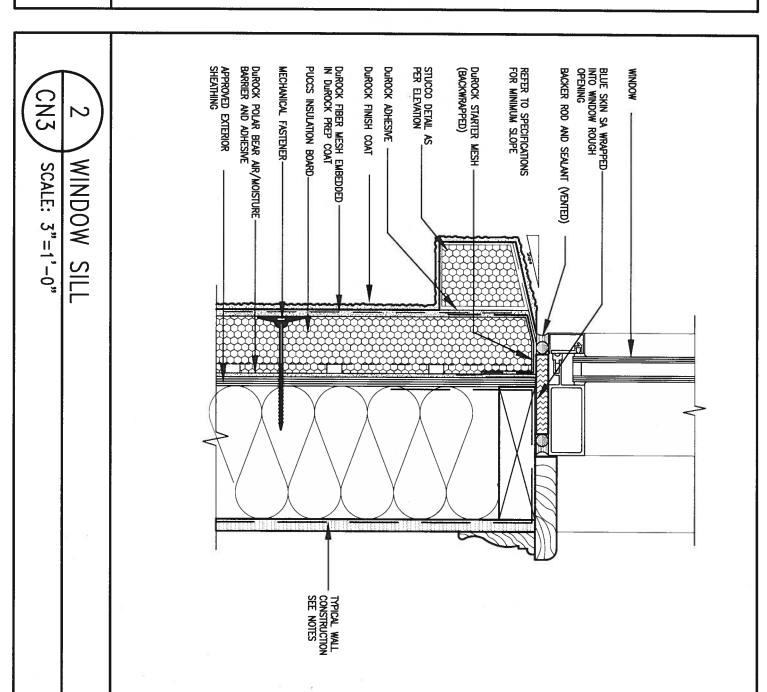


ALL STUCCO WALLS TO HAVE A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR. THE EXTERIOR SHEATHING MUST NOT BE GYPSUM BASED. ALL STUCCO TO BE INSTALLED AS PER MANUFACTURERS SPECIFICATIONS.

DETAILS ARE BASED ON DUROCK PUCCS SYSTEM

3


no. description

CONST NOTE 25591 GREEN VALLEY EAST BRADFORD 16023 42658 **CONSTRUCTION NOTES** Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work Drawings are not to be scaled. 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 RC MAY 2016 2 UPDATE TO 2018 JAN 11-18 RC 3/16" = 1'-0" file name 1 ISSUE FOR CLIENT REVIEW AUG 04-17 RC 16023-CN-A1 - Jan 11 2018 - 10:09 AM by va3design.com date RICHARD - H:\ARCHIVE\WORKING\2016\16023.BW\Units\CN NOTES\16023-CN-A1.dwg - Thu sign are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's

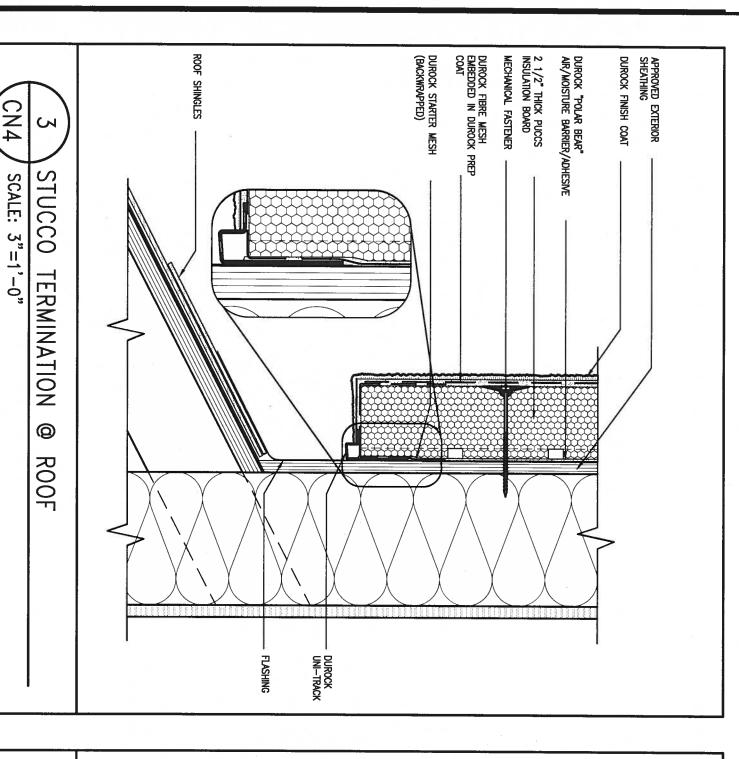

ALL STUCCO WALLS TO HAVE A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR. THE EXTERIOR SHEATHING MUST NOT BE GYPSUM BASED. ALL STUCCO TO BE INSTALLED AS PER MANUFACTURERS SPECIFICATIONS.

DETAILS ARE BASED ON DUROCK PUCCS SYSTEM

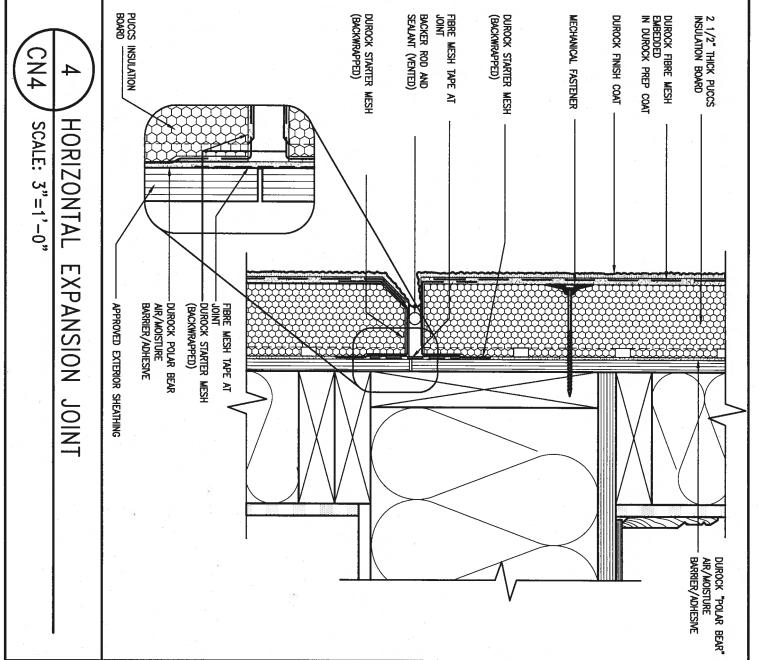

CONST NOTE 25591 BÇÎN GREEN VALLEY EAST BRADFORD 16023 VA3 Design Inc. 42658 MAY 2016 Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled. CONSTRUCTION NOTES 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 2 UPDATE TO 2018 JAN 11-18 RC drawn by RC 3/16" = 1'-0" 1 ISSUE FOR CLIENT REVIEW AUG 04-17 RC 16023-CN-A1 va3design.com no. description H:\ARCHIVE\WORKING\2016\16023.BW\Units\CN NOTES\16023-CN-A1.dwg RICHARD -- Thu - Jon 11 2018 - 10:10 AM specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly pro


APPROADE DETABLE

STOCKER DETAIL


CN5 SCALE: 3"=1"-0"

ALL STUCCO WALLS TO HAVE A MINIMUM 10mm AIR SPACE BEHIND THE CHADDING WITH POSITIVE DRAIMAGE TO THE EXTERIOR. THE EXTERIOR SHEATHING MUST NOT BE GYPSUM BASED. ALL STUCCO TO BE INSTALLED AS PER MANUFACTURERS SPECIFICATIONS.

DETAILS ARE BASED ON DUROCK PUCCS SYSTEM

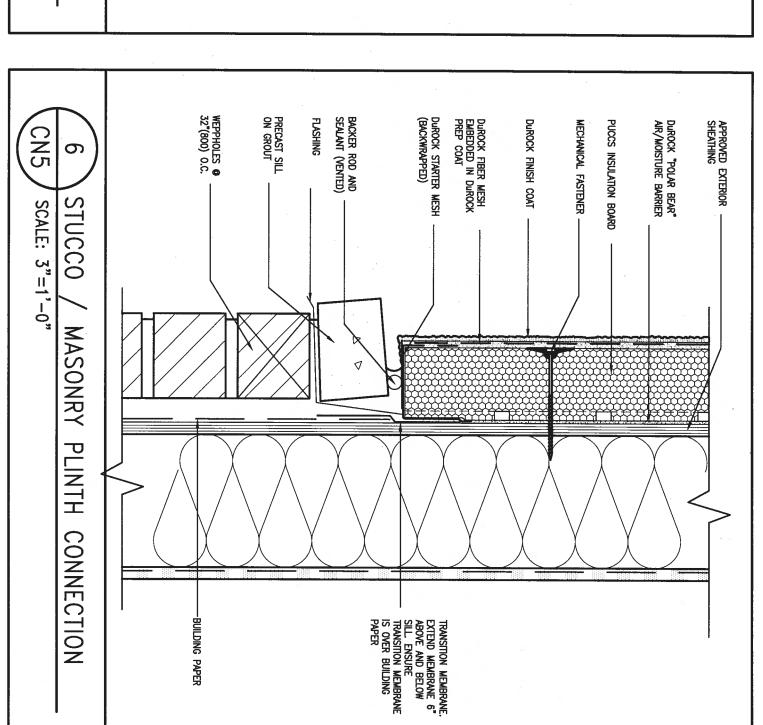

CONST NOTE BAYVIEW WELLINGTON 6 25591 GREEN VALLEY EAST BCIN BRADFORD 16023 42658 18 RC Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be socied. date MAY 2016 CONSTRUCTION NOTES 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 2 UPDATE TO 2018 JAN 11-18 RC drawn by RC 1 ISSUE FOR CLIENT REVIEW AUG 04-17 RC no. description date va3design.com All drawings specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN.

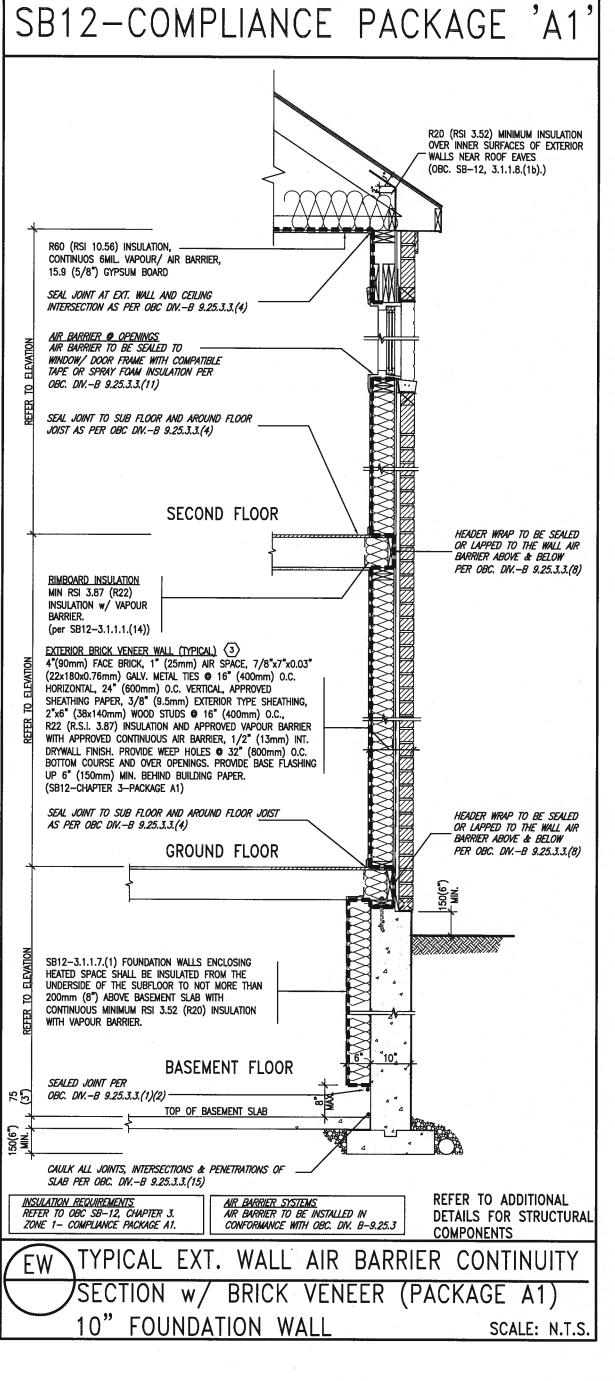


THE MINIMAL THERMAL PERFORMANCE OF BUILDING ENVELOPE AND EQUIPMENT SHALL CONFORM TO THE FOLLOWING SB-12 COMPLIANCE PACKAGE AS PER OBC SUPPLEMENTARY STANDARD SB-12, SECTION 3.1.1.1.

USE SB-12 COMPLIANCE PACKAGE (A1):

		THOTATOL WITT
COMPONENT	A1	Notes:
Ceiling with Attic Space Minimum RSI (R) value	10.56 (R60)	R20 at inner face of exterior walls
Ceiling without Attic Space Minimum RSI (R) value	5.46 (R31)	BATT or SPRAY
Exposed FLoor Minimum RSI (R) value	5.46 (R31)	BATT or SPRAY
Walls Above Grade Minimum RSI (R) value	3.87 (R22)	6" R22 BATT
Basement Walls Minimum RSI (R) value	3.52ci (R20ci)	OPTION TO USE R12+R10ci.
Edge of Below Grade Slab ≤600mm below grade Minimum RSI (R) value	1.76 (R10)	RIGID INSUL
Windows & Sliding glass Doors Maximum U—value	1.6	
Skylights Maximum U-value	2.8U	
Space Heating Equipment Minimum AFUE	96% Min.	NATURAL GAS
Hot Water Heater Minimum EF	0.8	NATURAL GAS
HRV Minimum Efficiency	75%	_
Drain Water Heat Recovery Unit (DWHR)	Dependent on n	Maximum 2 Required. umber of ahowers installed. 3.1.1.12 for information


ci— Denotes Continuous Insulation without framing interruption.



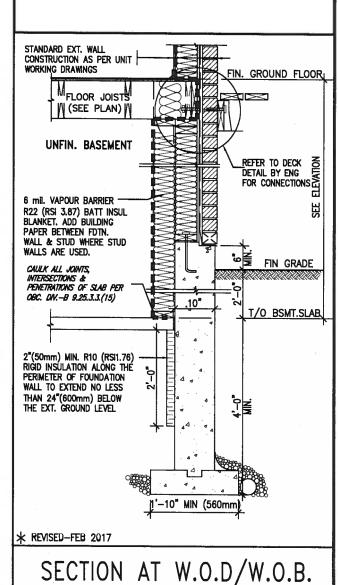

SCALE: N.T.S.



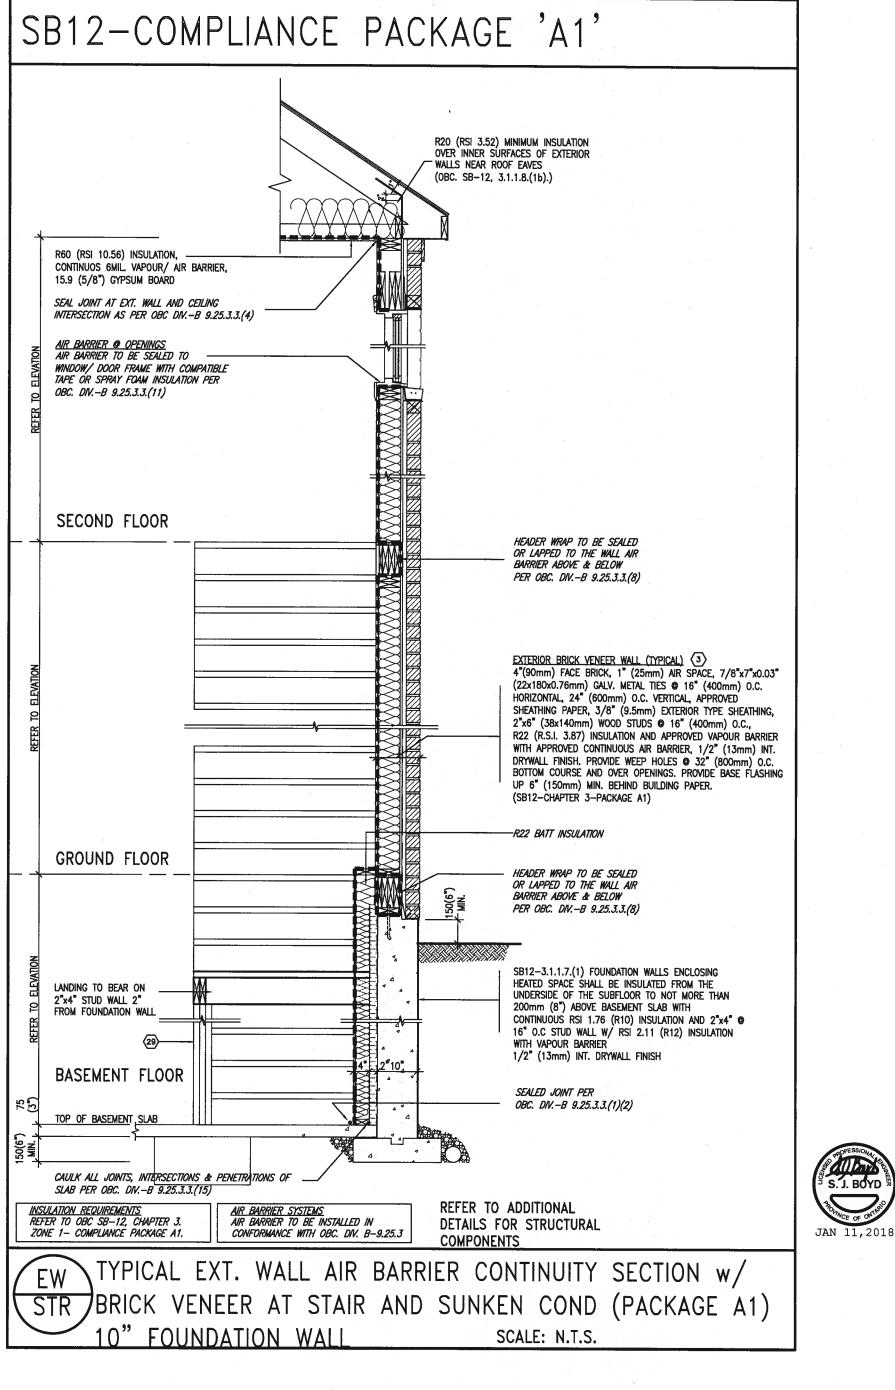



25591 42658 2 UPDATE TO 2018 JAN 11-18 RC

of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.

AUG 04-17 RC

1 ISSUE FOR CLIENT REVIEW

no. description

MAY 2016 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 drawn by t 416.630.2255 f 416.630.4782

va3design.com


BAYVIEW WELLINGTON GREEN VALLEY EAST

CONST NOTE


16023

BRADFORD **CONSTRUCTION NOTES** 3/16" = 1'-0" 16023-CN-A1

RICHARD - H:\ARCHIVE\WORKING\2016\16023.BW\Units\CN NOTES\16023-CN-A1.dwg - Thu - Jan 11 2018 - 10:10 AM

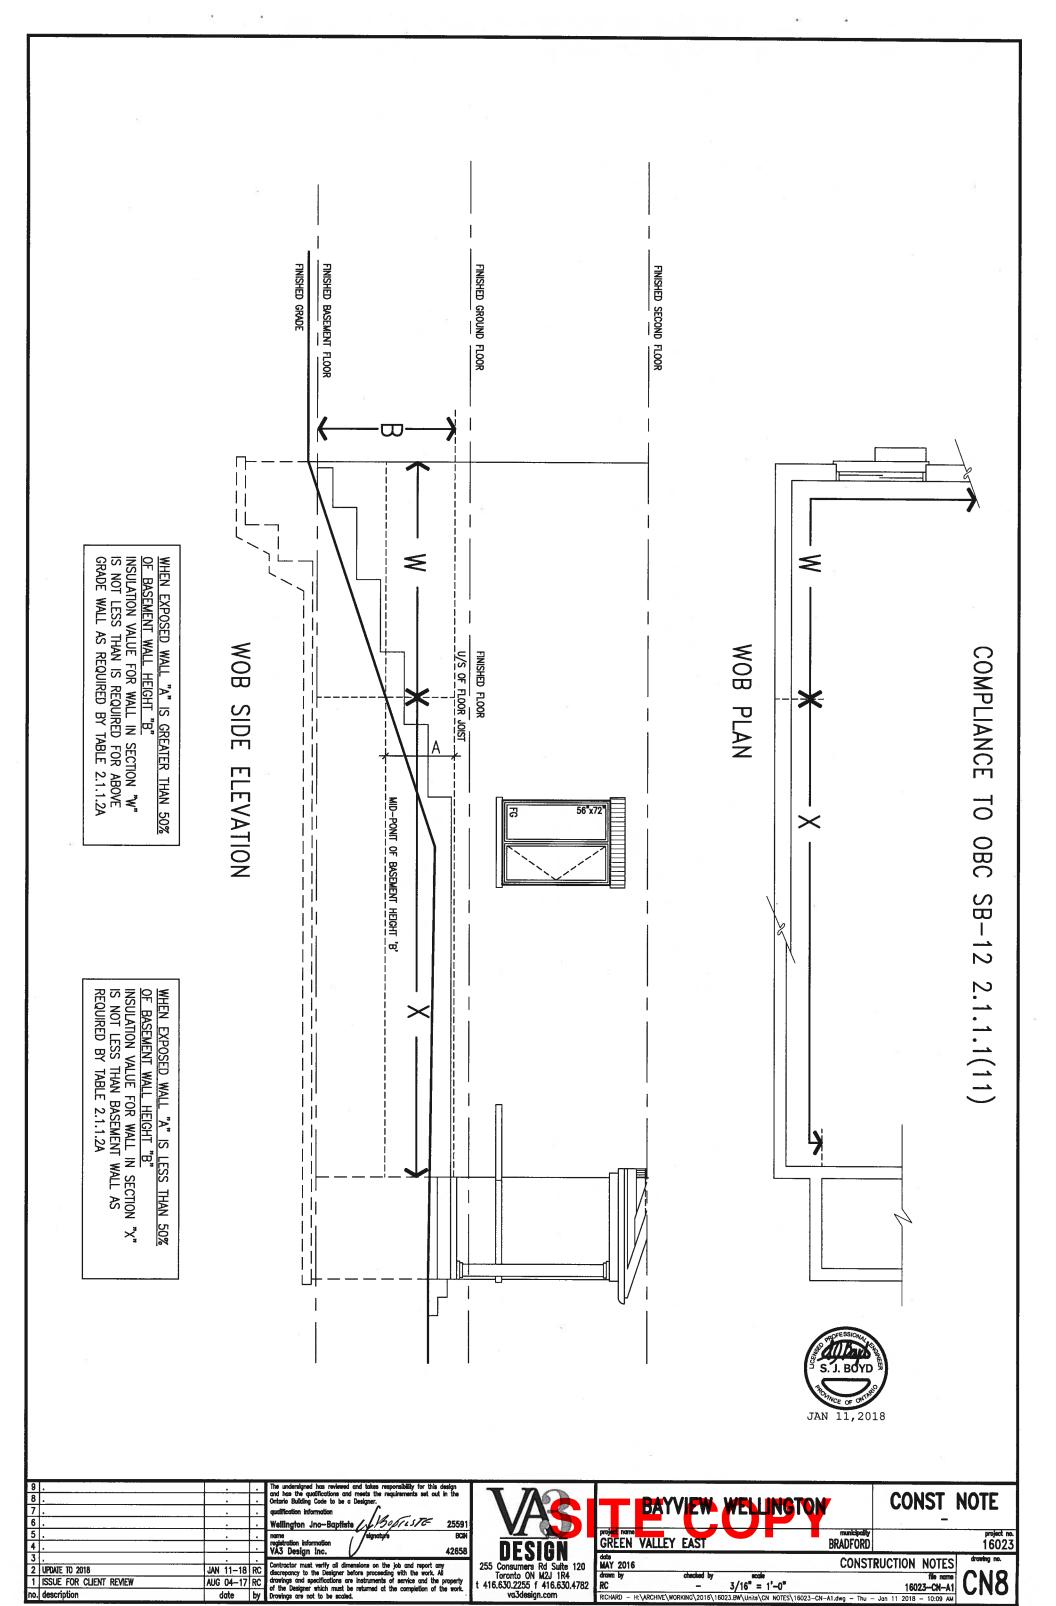



All drawings specifications, related documents and design are the copyright property of VAS DESIGNI. Reproduction of this property in whole or in part is strictly prohibited without VAS DESIGNI's written pen

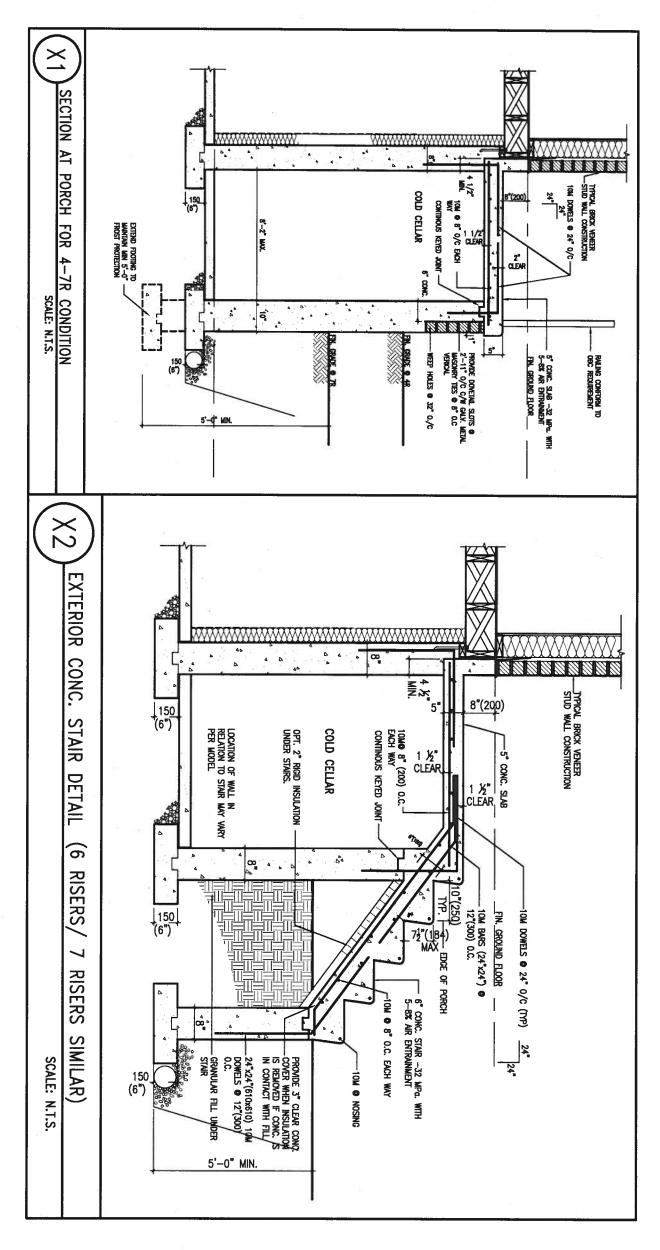




9 . 8 . 7 . 6 .	· · ·	The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the ontario Building Code to be a Designer, qualification information Wellington Jno-Bapfiste	VAS	BAYVIEW WELLINGTON	CONST_NOTE			
5 . 4 . 3 . 2 UPDATE TO 2018	JAN 11-18 RC	name registration information / signature BCN 425 Design Inc. 42658 Contractor must verify all dimensions on the job and report any	DESIGN 255 Consumers Rd Suite 120	GREEN VALLEY EAST BRADFOR	16023 TRUCTION NOTES drawing no.			
1 ISSUE FOR CLIENT REVIEW no. description		discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.	Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 va3design.com	drawn by	16023-CN-A1 - Jon 11 2018 - 10:09 AM			
All drawings specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.								

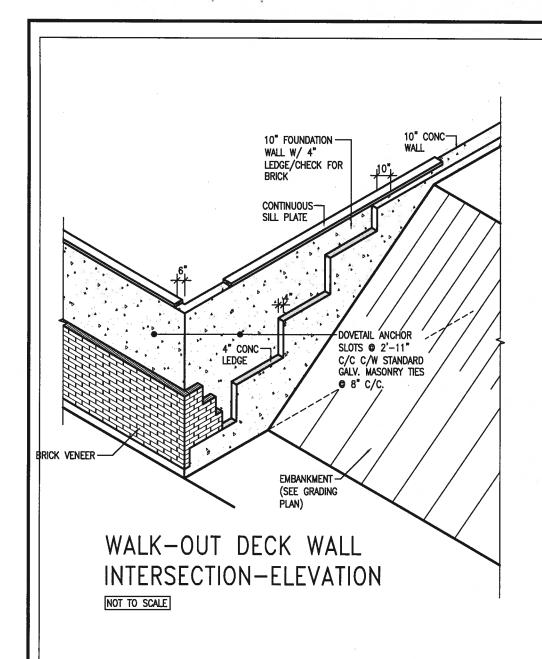

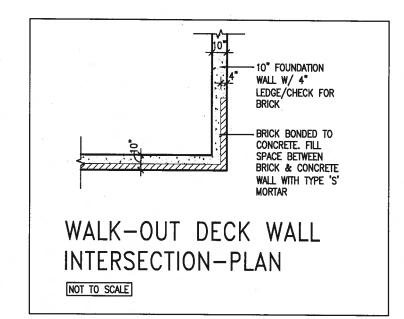



(10" FOUNDATION WALL)

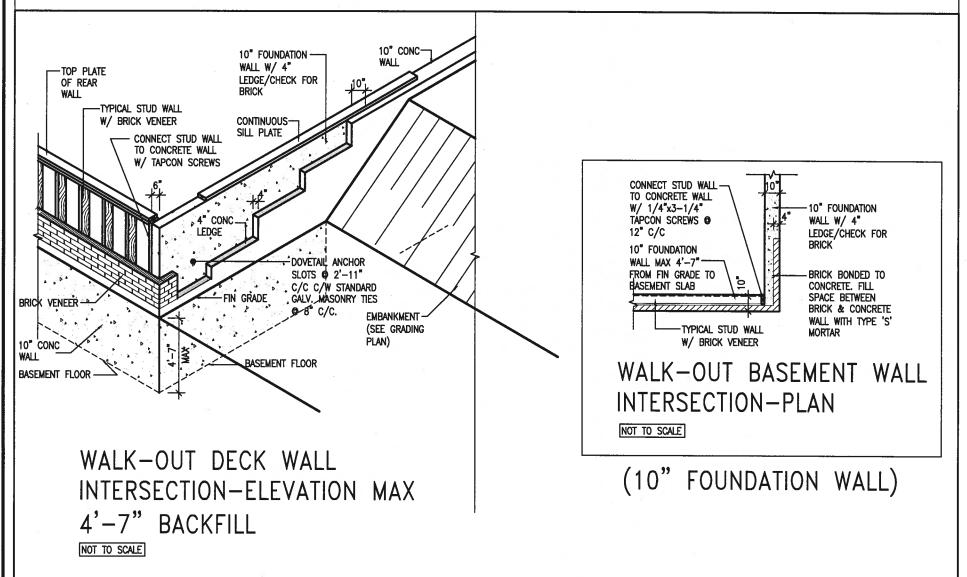



9 . 8 . 7 . 6 .			The undersigned has reviewed and takes responsibility for this design and has the qualifications and meats the requirements set out in the Ontario Building Code to be a Designer. qualification information Wellington Jno-Bapfiste (1990) 11572 2559	VAS		WELLINGTON	CONST_ NOTE
5 . 4 .		<u>.</u>	name signatu/e BCII registration information YA3 Design Inc. 42658	DEGLON	GREEN VALLEY EAST	BRADFORI	16023
2 UPDATE TO 2018 1 ISSUE FOR CLIENT REVIEW no. description	JAN 11-18 AUG 04-17 date	RC	Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.	255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 vo3design.com		3/16" = 1'-0" 16023.BW\Units\CN NOTES\16023-CN-A1.dwg - Thu	file name 16023-CN-A1

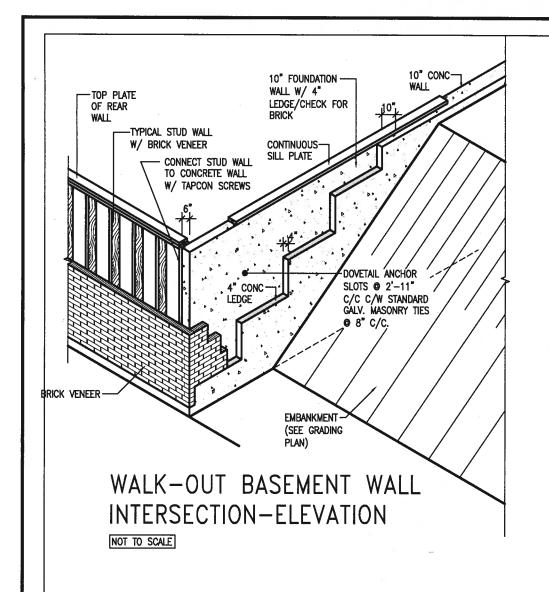

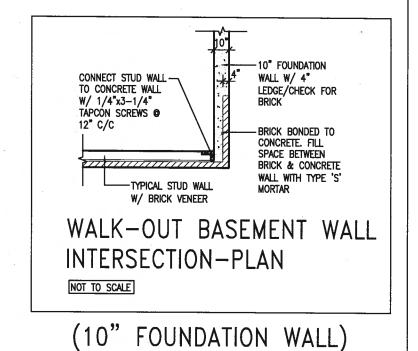

STANDARD EXT. WALL CONSTRUCTION AS PER UNIT WORKING DRAWINGS FIN. GROUND FLOOR WEEP HOLES @2'8" FLOOR JOISTS (800mm)0.C. (SEE PLAN) HORIZONTAL & CONTINOUS FLASHING 용 Ë SADE. BRICK BONDED FOUNDATION WALL \$. Ĭ (150mm) UNFIN. BASEMENT MAX. 1/2" BRICK PROJECTION BRUSH COAT 6 mil VAPOUR BARRIER ĕ R20ci (RSI 3.52ci) INSUL BELOW GRADE & R22 (RSI 3.87) ABOVE GRADE DAMPPROOF BETWEEN FOTH WALL & Insulation W/ Building Paper 2 CONT. WATERPROOF DRAINAGE LAYER, BITUMEN DAMPPROOFING 10"(250mm) POURED FDTN WALL (20MPa) (254mm) T/O BSMT. SLAB 4"(100mm) WEEPING TILE 1'-10" MIN (480mm)

WALL SECTION FOR GRADE TO FIN.

FLOOR MORE THAN 4'7" (1400mm)

HEIGHT DIFFERENCE

SCALE: N.T.S.


STANDARD EXT. WALL CONSTRUCTION AS PER UNIT WORKING DRAWINGS FIN. GROUND FLOOR FLOOR JOISTS (SEE PLAN) -KNEE WALL 2"X6"(38mmX140mm) WOOD STUDS @ 12"(300mm) -WEEP HOLES © 2'8" (800mm)O.C. HORIZONTAL & CONTINOUS FLASHING UNFIN. BASEMENT -CONT. WATERPROOF DRAINAGE LAYER, BITUMEN DAMPPROOFING 10"(250mm) POURED CONC. FDTN WALL (20MPa) 6 mil VAPOUR BARRIER R20ci (RSI 3.52ci) INSUL BELOW CRADE & R22ci (RSI 3.87ci) ABOVE GRADE DAMPPROOF BETWEEN FOTN WALL & FIN. GRADE INSULATION W/ BUILDING PAPER 10" 1/2" BRICK PROJECTION T/O BSMT. SLAB 'n -4"(100mm) WEEPING TILE IN 6"(150mm) CRUSHED STONE SURROUND 1'-10" MIN (480mm)

TO BASEMENT

WALL SECTION FOR GRADE
SLAB 4'7"(1400mm)
MAX. HEIGHT DIFFERENCE
SCALE: N.T.S.



CONST NOTE BAYVIEW WELLINGTON 25591 BRADFORD GREEN VALLEY EAST 16023 VA3 Design Inc. 42658 MAY 2016 Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled. CONSTRUCTION NOTES 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 2 UPDATE TO 2018 JAN 11-18 RC drawn by RC 3/16" = 1'-0" 1 ISSUE FOR CLIENT REVIEW AUG 04-17 RC 16023-CN-A1 no. description date by H-\ARCHIVE\WORKING\2016\16023.BW\Units\CN NOTES\16023-CN-A1.dwg Jon 11 2018 - 10:09 AM related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DES

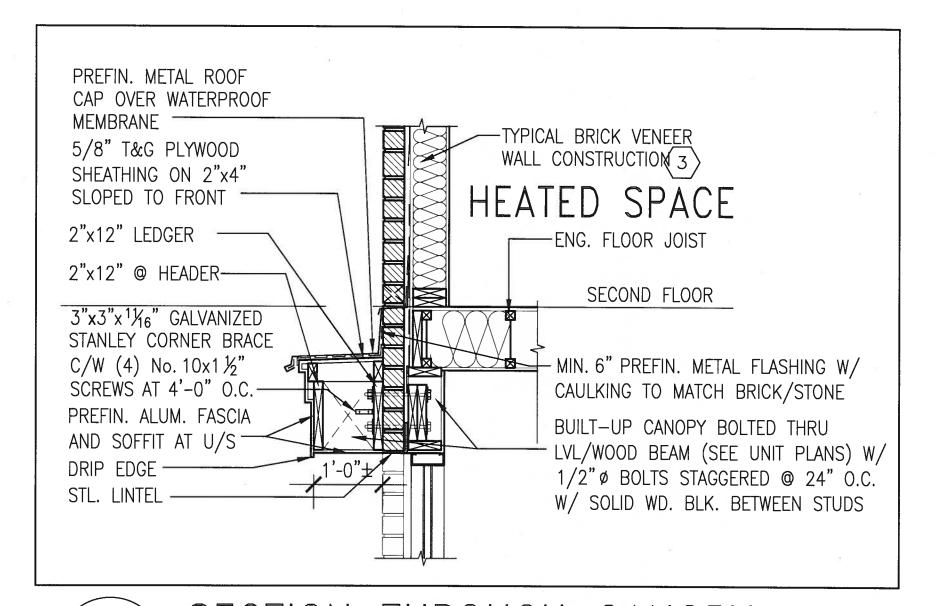


SECTION THROUGH CANOPY

SCALE 1/2" = 1'-0"

CN12



9 . 8 . 7 . 6 .		The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Bulliani, Code to be a Designer, qualification information Wellington Jno-Baptiste ///30/14376- 25591	VAS	BAYVIEW WELLINGTON	
5 .		nome elignature BCN registration information VA3 Design Inc. 42658	DESIGN	GREEN VALLEY EAST	BRADFORD project no. 1 6023
2 UPDATE TO 2018 1 ISSUE FOR CLIENT REVIEW	4	Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be socied.	255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 va3design.com	MAY 2016 drawn by checked by scale	CONSTRUCTION NOTES file name 1 6023-CN-A1

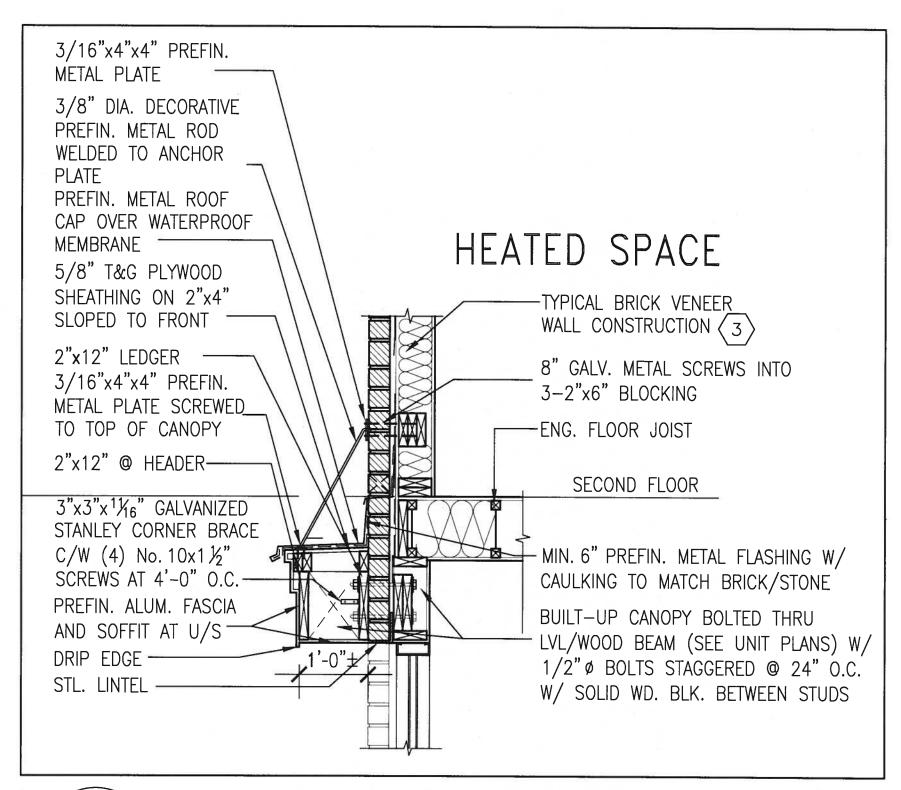


CN13

SECTION THROUGH CANOPY

W/ DECORATIVE ROD scale 1/2" = 1'-0"



9 . 8 . 7 . 6 .		· - · ·	The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ordario Building Code to be a Designer. qualification information Wellington Jno-Baptiste ### Property of the Pr	VAS	BAYVIEW WELLINGTON	CONST_NOTE
5 . 4 .		ŀ	name registration information VA3 Design Inc. 42658	DESIGN		municipality project in RADFORD 1602.
2 UPDATE TO 2018 1 ISSUE FOR CLIENT REVIEW	JAN 11-18 AUG 04-1	RC RC	Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property	255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782	data MAY 2016	CONSTRUCTION NOTES file name file name CN 1 3
no. description	date	T	of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.	va3design.com	RICHARD - H:\ARCHIVE\WORKING\2016\16023.BW\Units\CN NOTES\16023-CN-A1.6	16023-CN-A1 UNIJ

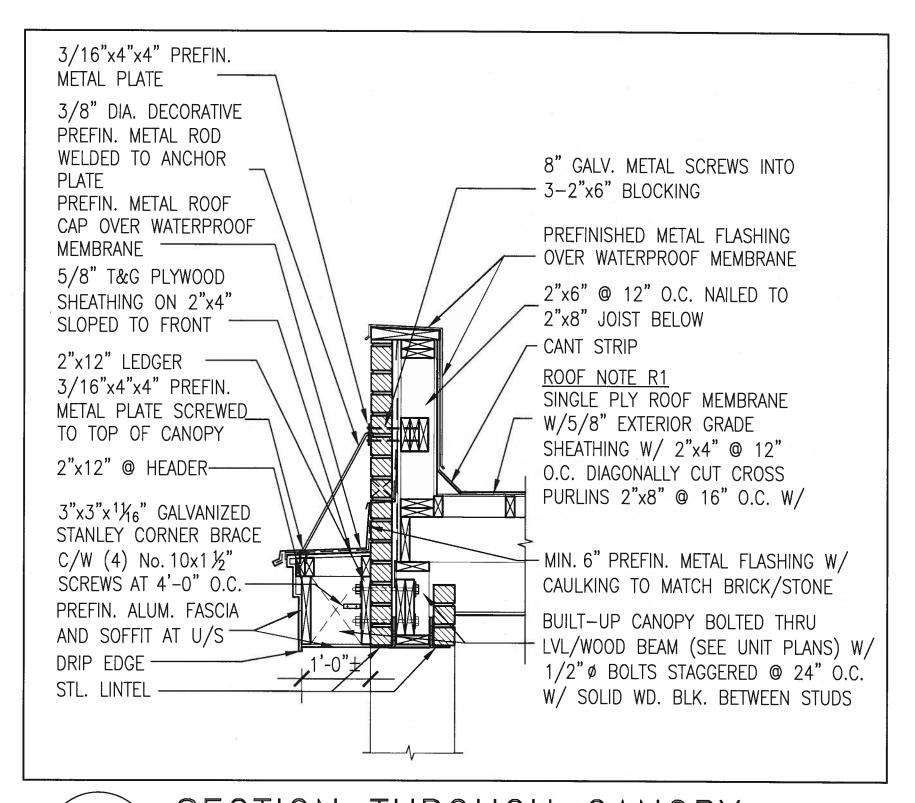

SECTION THROUGH CANOPY

W/ DECORATIVE ROD SCALE 1/2" = 1'-0"



9 . 8 . 7 . 6 .		· · ·	The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Orderio Building Code to be a Designer, qualification Information Wellington Jno-Baptiste // 25591	VAS	BAYVIEW WELLINGTON	CONST_NOTE
5 . 4 .		÷	name egistration information VA3 Design Inc. 42658	DESIGN	GREEN VALLEY EAST BRADFOR	16023
2 UPDATE TO 2018 1 ISSUE FOR CLIENT REVIEW	JAN 11-18	RC RC	Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property	255 Consumers Rd Suite 120 Toronto ON M2J 1R4	drown by checked by scale	TRUCTION NOTES drawing no.
no. description		+	of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.	t 416.630.2255 f 416.630.4782 va3design.com	RC - 3/16" = 1'-0" RICHARD - H:\ARCHIVE\WORKING\2016\18023.BW\Units\CN NOTES\16023-CN-A1.dwg - Thu	16023-CN-A1 - Jan 11 2018 - 10:19 AM