

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.

A. Project Information					
Building number, street name Barossa 6 S38-6 Lot 183				Lot:	183
				Lot/con.	
Municipality Bradford		Postal code	Plan number/ other description		
B. Individual who reviews and takes responsibility for design activities					
Name David DaCosta		Firm gtaDesigns Inc.			
Street address 2985 Drew Road, Suite 202				Unit no.	Lot/con.
Municipality Mississauga		Postal code L4T 0A4	Province Ontario	E-mail hvac@gtadesigns.ca	
Telephone number (905) 671-9800		Fax number		Cell number	
C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1 of Division C]					
☐ House		☒ HVAC – House		☐ Building Structural	
☐ Small Buildings		☐ Building Services		☐ Plumbing – House	
☐ Large Buildings		☐ Detection, Lighting and Power		☐ Plumbing – All Buildings	
☐ Complex Buildings		☐ Fire Protection		☐ On-site Sewage Systems	
Description of designer's work				Model Certification	Project #: PJ-00041
					Layout #: JB-07270
Heating and Cooling Load Calculations		Main	X	Builder	Bayview Wellington
Air System Design		Alternate		Project	Green Valley East
Residential mechanical ventilation Design Summary		Area Sq ft:	2889	Model	Barossa 6
Residential System Design per CAN/CSA-F280-12					S38-6 Lot 183
Residential New Construction - Forced Air				SB-12	Package A1
D. Declaration of Designer					
I, <u>David DaCosta</u> declare that (choose one as appropriate): (print name) ☐ I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4 Division C of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories. Individual BCIN: _____ Firm BCIN: _____ ☒ I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5 of Division C, of the Building Code. Individual BCIN: <u>32964</u> Basis for exemption from registration: <u>Division C 3.2.4.1. (4)</u> ☐ The design work is exempt from the registration and qualification requirements of the Building Code. Basis for exemption from registration and qualification:					
I certify that: 1. The information contained in this schedule is true to the best of my knowledge. 2. I have submitted this application with the knowledge and consent of the firm.					
<u>June 25, 2021</u> Date			 Signature of Designer		

NOTE:

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) d), of Division C, Article 3.2.5.1. of Division C and all other persons who are exempt from qualifications under Subsections 3.2.4 . and 3.2.5. of Division C.
- Schedule 1 does not require to be completed a holder of a license, temporary license, or a certificate of authorization, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited licence to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.

Heat loss and gain calculation summary sheet				CSA-F280-M12 Standard Form No. 1	
These documents issued for the use of Bayview Wellington				Layout No.	
and may not be used by any other persons without authorization. Documents for permit and/or construction are signed in red.				JB-07270	
Building Location					
Address (Model): S38-6 Lot 183			Site: Green Valley East		
Model: Barossa 6			Lot: 183		
City and Province: Bradford			Postal code:		
Calculations based on					
Dimensional information based on:			VA3 Design11/May/2012		
Attachment: Detached			Front facing: East/West		Assumed? Yes
No. of Levels: 3 Ventilated? Included			Air tightness: 1961-Present (ACH=3.57)		Assumed? Yes
Weather location: Bradford			Wind exposure: Sheltered		
HRV? VanEE 65H HRV			Internal shading: Light-translucent		Occupants: 5
Sensible Eff. at -25C 60%		Apparent Effect. at -0C 83%		Units: Imperial	Area Sq ft: 2889
Sensible Eff. at -0C 75%					
Heating design conditions			Cooling design conditions		
Outdoor temp -9.4 Indoor temp: 72 Mean soil temp: 48			Outdoor temp 86 Indoor temp: 75 Latitude: 44		
Above grade walls			Below grade walls		
Style A: As per OBC SB12 Package A1 R 22			Style A: As per OBC SB12 Package A1 R 20ci		
Style B:			Style B:		
Style C:			Style C:		
Style D:			Style D:		
Floors on soil			Ceilings		
Style A: As per Selected OBC SB12 Package A1			Style A: As per Selected OBC SB12 Package A1 R 60		
Style B:			Style B: As per Selected OBC SB12 Package A1 R 31		
Exposed floors			Style C:		
Style A: As per Selected OBC SB12 Package A1 R 31			Doors		
Style B:			Style A: As per Selected OBC SB12 Package A1 R 4.00		
Windows			Style B:		
Style A: As per Selected OBC SB12 Package A1 R 3.55			Style C:		
Style B:			Skylights		
Style C:			Style A: As per Selected OBC SB12 Package A1 R 2.03		
Style D:			Style B:		
Attached documents: As per Shedule 1		Heat Loss/Gain Caculations based on CSA-F280-12 Effective R-Values			
Notes: Residential New Construction - Forced Air					
Calculations performed by					
Name: David DaCosta			Postal code: L4T 0A4		
Company: gtaDesigns Inc.			Telephone: (905) 671-9800		
Address: 2985 Drew Road, Suite 202			Fax:		
City: Mississauga			E-mail hvac@gtadesigns.ca		

Builder: **Bayview Wellington**

Date: **June 25, 2021**

Project: **Green Valley East**

Model: **Barossa 6
S38-6 Lot 183**

System 1

I review and take responsibility for the design work and am qualified in the appropriate category as an "other designer" under Division C subsection 3.2.5. of the Building Code.

Individual BCIN: 32964

David DaCosta

Project # **PJ-00041**
Layout # **JB-07270**

Page 3

DESIGN LOAD SPECIFICATIONS		AIR DISTRIBUTION & PRESSURE		FURNACE/AIR HANDLER DATA:		BOILER/WATER HEATER DATA:		A/C UNIT DATA:	
Level 1 Net Load	18,244 btu/h	Equipment External Static Pressure	0.5 "w.c.	Make	Amana	Make	Type	Amana	2.5 Ton
Level 2 Net Load	19,796 btu/h	Additional Equipment Pressure Drop	0.225 "w.c.	Model	AMEC960803BNA	Model		Cond.-----	2.5
Level 3 Net Load	19,143 btu/h	Available Design Pressure	0.275 "w.c.	Input Btu/h	80000	Input Btu/h		Coil -----	2.5
Level 4 Net Load	0 btu/h	Return Branch Longest Effective Length	300 ft	Output Btu/h	76800	Output Btu/h			
Total Heat Loss	57,183 btu/h	R/A Plenum Pressure	0.138 "w.c.	E.s.p.	0.50 " W.C.	Min.Output Btu/h	AWH		
Total Heat Gain	29,063 btu/h	S/A Plenum Pressure	0.14 "w.c.	Water Temp	deg. F.	Blower DATA:			
		Heating Air Flow Proportioning Factor	0.0205 cfm/btuh	AFUE	96%	Blower Speed Selected:	W2	Blower Type	ECM
Building Volume Vb	35880 ft³	Cooling Air Flow Proportioning Factor	0.0403 cfm/btuh	Aux. Heat				(Brushless DC OBC 12.3.1.5.(2))	
Ventilation Load	1,188 Btu/h.	R/A Temp	70 deg. F.	SB-12 Package	Package A1	Heating Check	1172 cfm	Cooling Check	1172 cfm
Ventilation PVC	79.5 cfm	S/A Temp	131 deg. F.						
Supply Branch and Grill Sizing		Diffuser loss	0.01 "w.c.	Temp. Rise>>>	61 deg. F.	Selected cfm>	1172 cfm	Cooling Air Flow Rate	1172 cfm

	Level 1													Level 2													
S/A Outlet No.	2	3	4	5										6	7	8	9	10	11	12	13	14					
Room Use	BASE	BASE	BASE	BASE										KIT	KIT	STUDY	MUD	FOY	PWD	DIN	GRT	GRT					
Btu/Outlet	4561	4561	4561	4561										2351	2351	2329	1310	3146	815	3447	2023	2023					
Heating Airflow Rate CFM	93	93	93	93										48	48	48	27	64	17	71	41	41					
Cooling Airflow Rate CFM	12	12	12	12										83	83	105	7	48	11	96	82	82					
Duct Design Pressure	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13			
Actual Duct Length	35	44	26	24										45	50	5	23	32	23	29	53	43					
Equivalent Length	70	110	100	90	140	70	70	70	70	70	70	70	70	160	170	80	170	130	160	120	120	110	70	70			
Total Effective Length	70	145	144	116	164	70	70	70	70	70	70	70	70	205	220	85	193	162	183	149	173	153	70	70			
Adjusted Pressure	0.19	0.09	0.09	0.11	0.08	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.06	0.06	0.15	0.07	0.08	0.07	0.09	0.08	0.08	0.19	0.19			
Duct Size Round	6	6	6	6										6	6	6	4	5	3	6	6	6					
Outlet Size	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	3x10	3x10	3x10	4x10	4x10	4x10	4x10	4x10			
Trunk	C	C	B	E										D	D	A	E	E	E	C	D	D					

	Level 3										Level 4													
S/A Outlet No.	15	16	17	18	19	20	21	22	23	24														
Room Use	MAST	ENS	BED 2	BATH	BED 3	BED 4	BED 4	ENS 2	LAUND	WIC														
Btu/Outlet	3410	2295	1384	660	1717	2944	2944	2158	794	837														
Heating Airflow Rate CFM	70	47	28	14	35	60	60	44	16	17														
Cooling Airflow Rate CFM	96	60	44	15	46	76	76	66	42	7														
Duct Design Pressure	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	
Actual Duct Length	60	63	49	47	50	51	46	47	31	44														
Equivalent Length	140	150	150	140	140	150	140	150	150	140	70	70	70	70	70	70	70	70	70	70	70	70	70	
Total Effective Length	200	213	199	187	190	201	186	197	181	184	70	70	70	70	70	70	70	70	70	70	70	70	70	
Adjusted Pressure	0.07	0.06	0.07	0.07	0.07	0.06	0.07	0.07	0.07	0.07	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19		
Duct Size Round	6	6	6	3	6	6	6	6	5	3														
Outlet Size	4x10	4x10	4x10	3x10	4x10	4x10	4x10	4x10	3x10	3x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10		
Trunk	D	D	C	B	B	E	E	E	B	C														

Return Branch And Grill Sizing	Grill Pressure Loss										0.02 "w.c.
R/A Inlet No.	1R	2R	3R	4R	5R	6R	7R	8R	9R	10R	11R
Inlet Air Volume CFM	187	400	180	105	150	150					
Duct Design Pressure	0.12	0.12	0.12	0.12	0.12	0.12	0.12	0.12	0.12	0.12	0.12
Actual Duct Length	9	16	22	56	31	40					
Equivalent Length	155	175	140	155	160	140	50	50	50	50	50
Total Effective Length	164	191	162	211	191	180	50	50	50	50	50
Adjusted Pressure	0.07	0.06	0.07	0.06	0.06	0.07	0.24	0.24	0.24	0.24	0.24
Duct Size Round	8.0	11.0	8.0	6.0	8.0	7.5					
Inlet Size	FLC	8	8	8	8	8					
" "	x	x	x	x	x	x	x	x	x	x	x
Inlet Size	9X6	30	14	14	14	14					
Trunk	Y	Y	Z	Z	Z	Y					

Return Trunk Duct Sizing	Trunk	CFM	Press.	Round	Rect. Size
Drop		1172	0.06	16.5	24x10
Z		1172	0.06	16.5	32x8 24x10
Y		737	0.06	14.0	22x8 18x10
X					
W					
V					
U					
T					
S					
R					
Q					

Supply Trunk Duct Sizing	Trunk	CFM	Press.	Round	Rect. Size
A		1171	0.06	16.5	32x8 24x10
B		757	0.06	14.0	22x8 18x10
C		599	0.06	13.0	18x8 14x10
D		296	0.06	10.0	12x8 10x10
E		366	0.06	11.0	14x8 10x10
F					
G					
H					
I					
J					
K					

2012 OBC

Builder: Bayview Wellington

Date: June 25, 2021

Project: Green Valley East

Model: Barossa 6 S38-6 Lot 183

System 1

Weather Data Bradford 44 -9.4 86 22 48.2

Heat Loss ^T 81.4 deg. F Ht gain ^T 11 deg. F GTA: 2889

Project # PJ-00041
Layout # JB-07270

Level 1

BASE

Run ft. exposed wall A	164 A	A	A	A	A	A	A	A	A	A	A	A	A
Run ft. exposed wall B	B	B	B	B	B	B	B	B	B	B	B	B	B
Ceiling height	4.5 AG	4.5 AG	4.5 AG	4.5 AG	4.5 AG	4.5 AG	4.5 AG	4.5 AG	4.5 AG	4.5 AG	4.5 AG	4.5 AG	4.5 AG
Floor area	1175 Area	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area
Exposed Ceilings A	A	A	A	A	A	A	A	A	A	A	A	A	A
Exposed Ceilings B	B	B	B	B	B	B	B	B	B	B	B	B	B
Exposed Floors	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr
Gross Exp Wall A	738												
Gross Exp Wall B													

Components	R-Values	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain
North Shaded	3.55	22.93	11.62	3	69	35											
East/West	3.55	22.93	29.56	10	229	296											
South	3.55	22.93	22.50	3	69	68											
WOB Windows	3.55	22.93	27.86														
Skylight	2.03	40.10	88.23														
Doors	4.00	20.35	2.75	21	427	58											
Net exposed walls A	21.12	3.85	0.52	701		365											
Net exposed walls B	17.03	4.78	0.65														
Exposed Ceilings A	59.22	1.37	0.64														
Exposed Ceilings B	27.65	2.94	1.37														
Exposed Floors	29.80	2.73	0.17														
Foundation Conductive Heatloss																	
Total Conductive	Heat Loss																
	Heat Gain																
Air Leakage	Heat Loss/Gain	1.2326	0.0455														
Ventilation	Case 1		0.07														
	Case 2		14.95														
	Case 3	x	0.03														
Heat Gain People			239														
Appliances Loads	1 =.25 percent		4815														
Duct and Pipe loss			10%														
Level HL Total	18,244			18244													
Level HG Total	1,185				1185												

Level 2

KIT

STUDY

MUD

FOY

PWD

DIN

GRT

Run ft. exposed wall A	36 A	21 A	9 A	24 A	6 A	34 A	34 A	A	A	A	A	A	A
Run ft. exposed wall B	B	B	B	B	B	B	B	B	B	B	B	B	B
Ceiling height	11.0	11.0	13.0	12.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0
Floor area	297 Area	133 Area	27 Area	68 Area	36 Area	391 Area	222 Area	Area	Area	Area	Area	Area	Area
Exposed Ceilings A	A	A	A	A	A	A	5 A	A	A	A	A	A	A
Exposed Ceilings B	B	B	B	B	B	B	B	B	B	B	B	B	B
Exposed Floors	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr
Gross Exp Wall A	396	231	117	288	66	374	374						
Gross Exp Wall B													

Components	R-Values	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain
North Shaded	3.55	22.93	11.62														
East/West	3.55	22.93	29.56	71	1628	2099											
South	3.55	22.93	22.50														
Existing Windows	1.99	40.90	23.66														
Skylight	2.03	40.10	88.23														
Doors	4.00	20.35	2.75														
Net exposed walls A	17.03	4.78	0.65	325	1553	210	205	980	132	96	459	62	243	1161	157	53	253
Net exposed walls B	8.50	9.58	1.29														
Exposed Ceilings A	59.22	1.37	0.64														
Exposed Ceilings B	27.65	2.94	1.37														
Exposed Floors	29.80	2.73	0.17														
Foundation Conductive Heatloss			x														
Total Conductive	Heat Loss																
	Heat Gain																
Air Leakage	Heat Loss/Gain	0.4446	0.0455														
Ventilation	Case 1		0.03														
	Case 2		14.95														
	Case 3	x	0.03														
Heat Gain People			239														
Appliances Loads	1 =.25 percent		4815														
Duct and Pipe loss			10%														
Level HL Total	19,796			4702				2329	2601		1310		3146			815	
Level HG Total	14,814				4116						173		1179			268	

I review and take responsibility for the design work and am qualified in the appropriate category as an "other designer" under

Division C subsection 3.2.5. of the Building Code. Individual BCIN:

32964


Name

David DaCosta

SB-12 Package

Package A1

Total Heat Loss	57,183	btu/h
Total Heat Gain	29,063	btu/h



I review and take responsibility for the design work and am qualified in the appropriate category as an "other designer" under Division C subsection 3.2.5. of the Building Code.

Individual BCIN: 32964

David DaCosta

Package: **Package A1**
Project: **Bradford** Model: **S38-6 Lot 183**

RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

For systems serving one dwelling unit & conforming to the Ontario Building Code, O.reg 332/12

Location of Installation	
Lot #	Plan #
Township	Bradford
Roll #	Permit #
Address	

Builder	
Name	Bayview Wellington
Address	
City	
Tel	Fax

Installing Contractor	
Name	
Address	
City	
Tel	Fax

Combustion Appliances 9.32.3.1(1)		
a)	x	Direct vent (sealed combustion) only
b)		Positive venting induced draft (except fireplaces)
c)		Natural draft, B-vent or induced draft fireplaces
d)		Solid fuel (including fireplaces)
e)		No combustion Appliances

Heating System		
x	Forced air	
	Non forced air	
	Electric space heat (if over 10% of heat load)	

House Type 9.32.3.1(2)		
I	x	Type a) or b) appliances only, no solid fuel
II		Type I except with solid fuel (including fireplace)
III		Any type c) appliance
IV		Type I or II either electric space heat
Other		Type I, II or IV no forced air

System Design Option		
1	Exhaust only / forced air system	
2	HRV WITH DUCTING / forced air system	
3	HRV simplified connection to forced air system	
4	HRV full ducting/not coupled to forced air system	
	Part 6 design	

Total Ventilation Capacity 9.32.3.3(1)			
Bsmt & Master Bdrm	2 @ 21.2 cfm	42.4 cfm	
Other Bedrooms	3 @ 10.6 cfm	31.8 cfm	
Bathrooms & Kitchen	5 @ 10.6 cfm	53 cfm	
Other rooms	5 @ 10.6 cfm	53 cfm	
Total		180.2	

Principal Ventilation Capacity 9.32.3.4(1)			
Master bedroom	1 @ 31.8 cfm	31.8 cfm	
Other bedrooms	3 @ 15.9 cfm	47.7 cfm	
Total		79.5	


Principal Exhaust Fan Capacity			
Make	Model	Location	
VanEE	65H HRV	Base	
129 cfm		Sones	or Equiv.

Heat Recovery Ventilator			
Make	VanEE		
Model	65H HRV		
	129 cfm high	80 cfm low	
Sensible efficiency @ -25 deg C		60%	
Sensible efficiency @ 0 deg C		75%	

Note: Installer to balance HRV/ERV to within 10 percent of PVC

Supplemental Ventilation Capacity	
Total ventilation capacity	180.2
Less principal exhaust capacity	79.5
REQUIRED supplemental vent. Capacity	100.7 cfm

Supplemental Fans 9.32.3.5.			
Location	cfm	Model	Sones
Ens	50	XB50	0.3
Ens 2	50	XB50	0.3
Bath	50	XB50	0.3
all fans HVI listed		Make	Broan or Equiv.

Designer Certification			
I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.			
Name	David DaCosta		
Signature			
HRAI #	5190	BCIN #	32964
Date	June 25, 2021		



2985 Drew Road, Suite 202, Mississauga, Ontario
L4T 0A4 Tel: 905-671-9800 Fax: 647-494-9643
e-mail dave@gtadesigns.ca

Energy Efficiency Design Summary: Prescriptive Method (Building Code Part 9, Residential)

Page 7
Project # PJ-00041
Layout # JB-07270

This form is used by a designer to demonstrate that the energy efficiency design of a house complies with the building code using the prescriptive method described in Subsection 3.1.1. of SB-12. This form is applicable where the ratio of gross area of windows/sidelights/skylights/glazing in doors and sliding glass doors to the gross area of peripheral walls is not more than 22%.

For use by Principal Authority

Application No:

Model/Certification Number

A. Project Information

Building number, street name Barossa 6 S38-6 Lot 183		Unit number	Lot/Con
Municipality Bradford	Postal code	Reg. Plan number / other description	

B. Prescriptive Compliance [indicate the building code compliance package being employed in the house design]

SB-12 Prescriptive (input design package):

Package A1

Table: 3.1.1.2.A

C. Project Design Conditions

Climatic Zone (SB-1):	Heat. Equip. Efficiency	Space Heating Fuel Source		
☒ Zone 1 (< 5000 degree days) ☐ Zone 2 (≥ 5000 degree days)	☒ ≥ 92% AFUE ☐ ≥ 84% < 92% AFUE	☒ Gas ☐ Oil	☐ Propane ☐ Electric	☐ Solid Fuel ☐ Earth Energy
Ratio of Windows, Skylights & Glass (W, S & G) to Wall Area		Other Building Characteristics		
Area of Walls = <u>388.51</u> m ² or <u>4181.9</u> ft ²	W, S & G % = <u>10.5%</u>	☐ Log/Post&Beam ☐ Slab-on-ground ☒ Air Conditioning ☐ Air Sourced Heat Pump (ASHP) ☐ Ground Source Heat Pump (GSHP)		
Area of W, S & G = <u>40.69</u> m ² or <u>438.0</u> ft ²	Utilize Window Averaging ☐ Yes ☒ No	☐ ICF Above Grade ☐ Walkout Basement ☐ Combo Unit		

D. Building Specifications [provide values and ratings of the energy efficiency components proposed]

Energy Efficiency Substitutions			
☐ ICF (3.1.1.2.(5) & (6) / 3.1.1.3.(5)) ☐ Combined space heating and domestic water heating systems (3.1.1.2(7) / 3.1.1.3.(7))			
☐ Airtightness substitution(s) Airtightness test required (Refer to Design Guide Attached)	☐ Table 3.1.1.4.B Required:		Permitted Substitution:
	☐ Table 3.1.1.4.C Required:		Permitted Substitution:
Building Component	Minimum RSI/R-Values or Maximum U-Value ¹		Efficiency Ratings
Thermal Insulation	Nominal	Effective	Windows & Doors Provide U-Value ⁽¹⁾ or ER rating
Ceiling with Attic Space	60	59.22	Windows/Sliding Glass Doors
Ceiling without Attic Space	31	27.65	Skylights
Exposed Floor	31	29.80	Mechanicals
Walls Above Grade	22	17.03	Heating Equip.(AFUE)
Basement Walls	20.0ci	21.12	HRV Efficiency (SRE% at 0°C)
Slab (all >600mm below grade)	x	x	DHW Heater (EF)
Slab (edge only ≤600mm below grade)	10	11.13	DWHR (CSA B55.1 (min. 42% efficiency))
Slab (all ≤600mm below grade, or heated)	10	11.13	Combined Heating System

(1) U value to be provided in either W/(m²·K) or Btu/(h·ft²·F) but not both.

E. Designer(s) [name(s) & BCIN(s), if applicable, of person(s) providing information herein to substantiate that design meets building code]

Name David DaCosta	BCIN 32964	Signature
------------------------------	----------------------	---------------

Package:
Project:

Package A1
Bradford

System:
Model:

System 1
S38-6 Lot 183

Air Leakage Calculations

Building Air Leakage Heat Loss				
B	LRairh	Vb	HL ^{AT}	HL ^{leak}
0.018	0.378	35880	81.4	19849

Building Air Leakage Heat Gain				
B	LRairh	Vb	HG ^{AT}	HG ^{Leak}
0.018	0.093	35880	11	660

Air Leakage Heat Loss/Gain Multiplier Table (Section 11)				
Level	Level Factor (LF)	Building Air	Level Conductive Heat Loss	Air Leakage Heat Loss Multiplier
Level 1	0.5	19849	8051	1.2326
Level 2	0.3		13394	0.4446
Level 3	0.2		14177	0.2800
Level 4	0		0	0.0000

Levels			
1	2	3	4
(LF)	(LF)	(LF)	(LF)
1.0	0.6	0.5	0.4
	0.4	0.3	0.3
		0.2	0.2
			0.1

HG LEAK		660	Air Leakage Heat Gain
BUILDING CONDUCTIVE HEAT GAIN		14502	
			0.0455

Levels this Dwelling	
3	

Ventilation Calculations

Vent	Ventilation Heat Loss					Ventilation Heat Gain				Vent	
	Ventilation Heat Loss					Ventilation Heat Gain					
	C	PVC	HL^T	(1-E) HRV	HLbvent	C	PVC	HG^T	HGbvent		
	1.08	79.5	81.4	0.17	1188	1.1	79.5	11	944		
Case 1					Case 1						
Case 1	Ventilation Heat Loss (Exhaust only Systems)					Ventilation Heat Gain (Exhaust Only Systems)					Case 1
	Case 1 - Exhaust Only					Case 1 - Exhaust Only		Multiplier			
	Level	LF	HLbvent	LVL Cond. HL	Multiplier	HGbvent	944	0.07			
	Level 1	0.5	1188	8051	0.07	Building	14502				
	Level 2	0.3		13394	0.03						
	Level 3	0.2		14177	0.02						
Level 4	0	0		0.00							
Case 2					Case 2						
Case 2	Ventilation Heat Loss (Direct Ducted Systems)					Ventilation Heat Gain (Direct Ducted Systems)					Case 2
				Multiplier				Multiplier			
	C	HL^T	(1-E) HRV	14.95		C	HG^T	11.88			
	1.08	81.4	0.17			1.08	11				
Case 3					Case 3						
Case 3	Ventilation Heat Loss (Forced Air Systems)					Ventilation Heat Gain (Forced Air Systems)					Case 3
			HLbvent	Multiplier				Vent Heat Gain	Multiplier		
	Total Ventilation Load		1188	0.03		HGbvent	HG*1.3	944	0.07		
						944	1				

Foundation Conductive Heatloss Level 1	Level 1	2127	Watts	7257	Btu/h
Foundation Conductive Heatloss Level 2	Level 2		Watts		Btu/h
Slab on Grade Foundation Conductive Heatloss			Watts		Btu/h
Walk Out Basement Foundation Conductive Heatloss			Watts		Btu/h

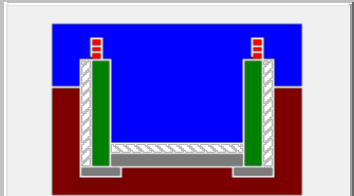
Envelope Air Leakage Calculator


Supplemental tool for CAN/CSA-F280

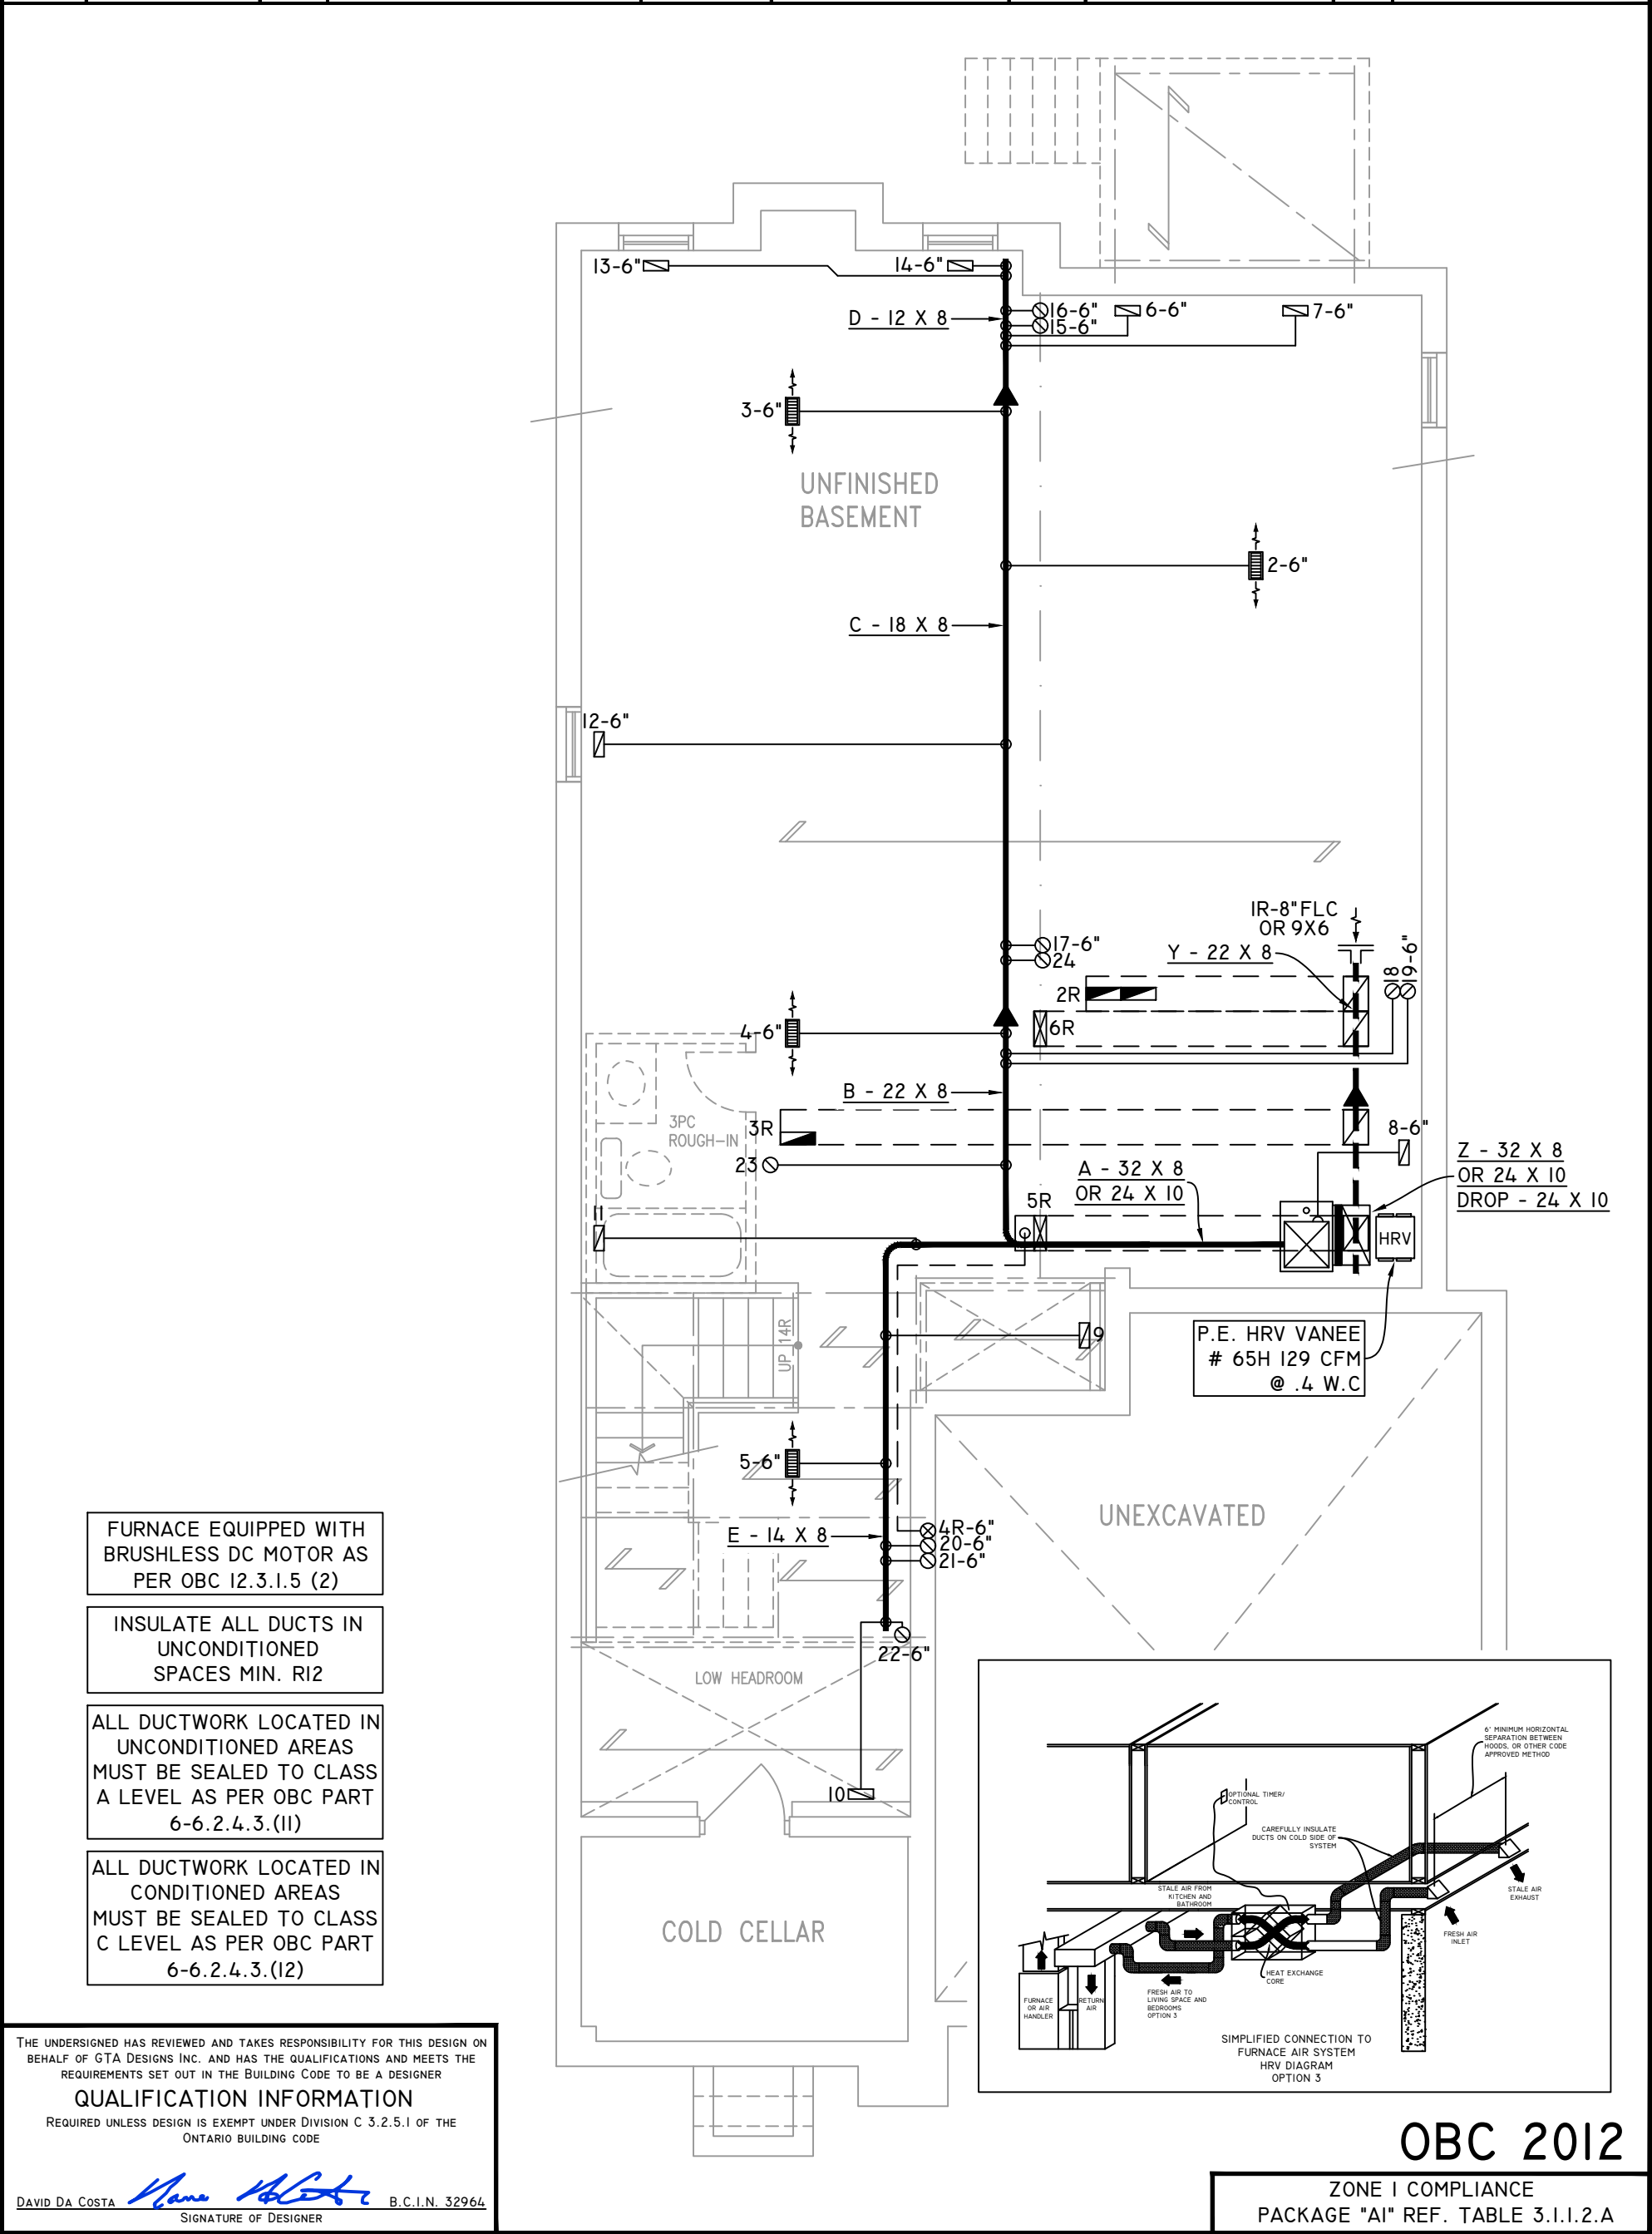
Weather Station Description				
Province:	Ontario ▼			
Region:	Bradford ▼			
Weather Station Location:	Open flat terrain, grass ▼			
Anemometer height (m):	10			
Local Shielding				
Building Site:	Suburban, forest ▼			
Walls:	Heavy ▼			
Flue:	Heavy ▼			
Highest Ceiling Height (m):	8.08			
Building Configuration				
Type:	Detached			
Number of Stories:	Two			
Foundation:	Shallow			
House Volume (m ³):	1016.11			
Air Leakage/Ventilation				
Air Tightness Type:	Present (1961-) (ACH=3.57)			
Custom BDT Data:	ELA @ 10 Pa. ▼ 322.44 cm ²			
	3.57 ACH @ 50 Pa			
Mechanical Ventilation (L/s):	Total Supply:		Total Exhaust:	
	39.75		39.75	
Flue #:	#1	#2	#3	#4
Diameter (mm):	0	0	0	0
Heating Air Leakage Rate (ACH/H):		0.378		
Cooling Air Leakage Rate (ACH/H):		0.093		

Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

Weather Station Description		
Province:	Ontario	▼
Region:	Bradford	▼
Site Description		
Soil Conductivity:	High conductivity: moist soil	▼
Water Table:	Normal (7-10 m, 23-33 Ft)	▼
Foundation Dimensions		
Floor Length (m):	19.35	 Insulation Configuration
Floor Width (m):	5.64	
Exposed Perimeter (m):	49.99	
Wall Height (m):	2.59	
Depth Below Grade (m):	1.22	
Window Area (m ²):	1.49	
Door Area (m ²):	1.95	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):		2127

	FLEX DUCT		LOW/HIGH WALL/KICK SUPPLY DIFFUSER		DUCT CONNECTION TO JOIST LINING		RETURN AIR GRILLE (SIZE INDICATED ON DRAWING)	S.A.	SUPPLY AIR
	RIGID ROUND DUCT		HRV EXHAUST GRILLE		RETURN AIR PIPE RISER		RETURN AIR RISER UP TO FLOOR ABOVE	R.A.	RETURN AIR
	SUPPLY DIFFUSER		SUPPLY AIR PIPE RISER		RETURN ROUND DUCT		RETURN AIR FROM BASEMENT SECOND FLOOR		THERMOSTAT
			VOLUME DAMPER				PRINCIPAL EXHAUST FAN SWITCH		W/R & PRINCIPAL EXHAUST FAN



NOTES

INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE.

ALL SUPPLY OUTLETS TO BE 5" DIA. UNLESS OTHERWISE SPECIFIED.

PROVIDE BALANCING DAMPERS ON ALL BRANCHES.

ALL R/A PARTITIONS 6" (FIRST FLOOR ONLY)

INSULATE DUCTS IN UNCONDITIONED SPACES R12 UNDERCUT ALL DOORS 1" MIN.

CONTRACTOR MUST WORK FROM APPROVED PLANS.

ANY ALTERATIONS TO THIS ORIGINAL PLAN ARE NOT THE RESPONSIBILITY OF GTA DESIGNS.

GTA DESIGNS MUST BE CONSULTED IF KITCHEN EXHAUST FAN EXCEEDS 700 CFM DEPRESSURIZATION MAY OCCUR WITH IN THE DWELLING.

GTADESIGNS


2985 DREW ROAD
SUITE 202,
MISSISSAUGA, ONT.
L4T 0A4 TEL: 905-671-9800
EMAIL: DAVE@GTADESIGNS.CA
WEB: WWW.GTADESIGNS.CA

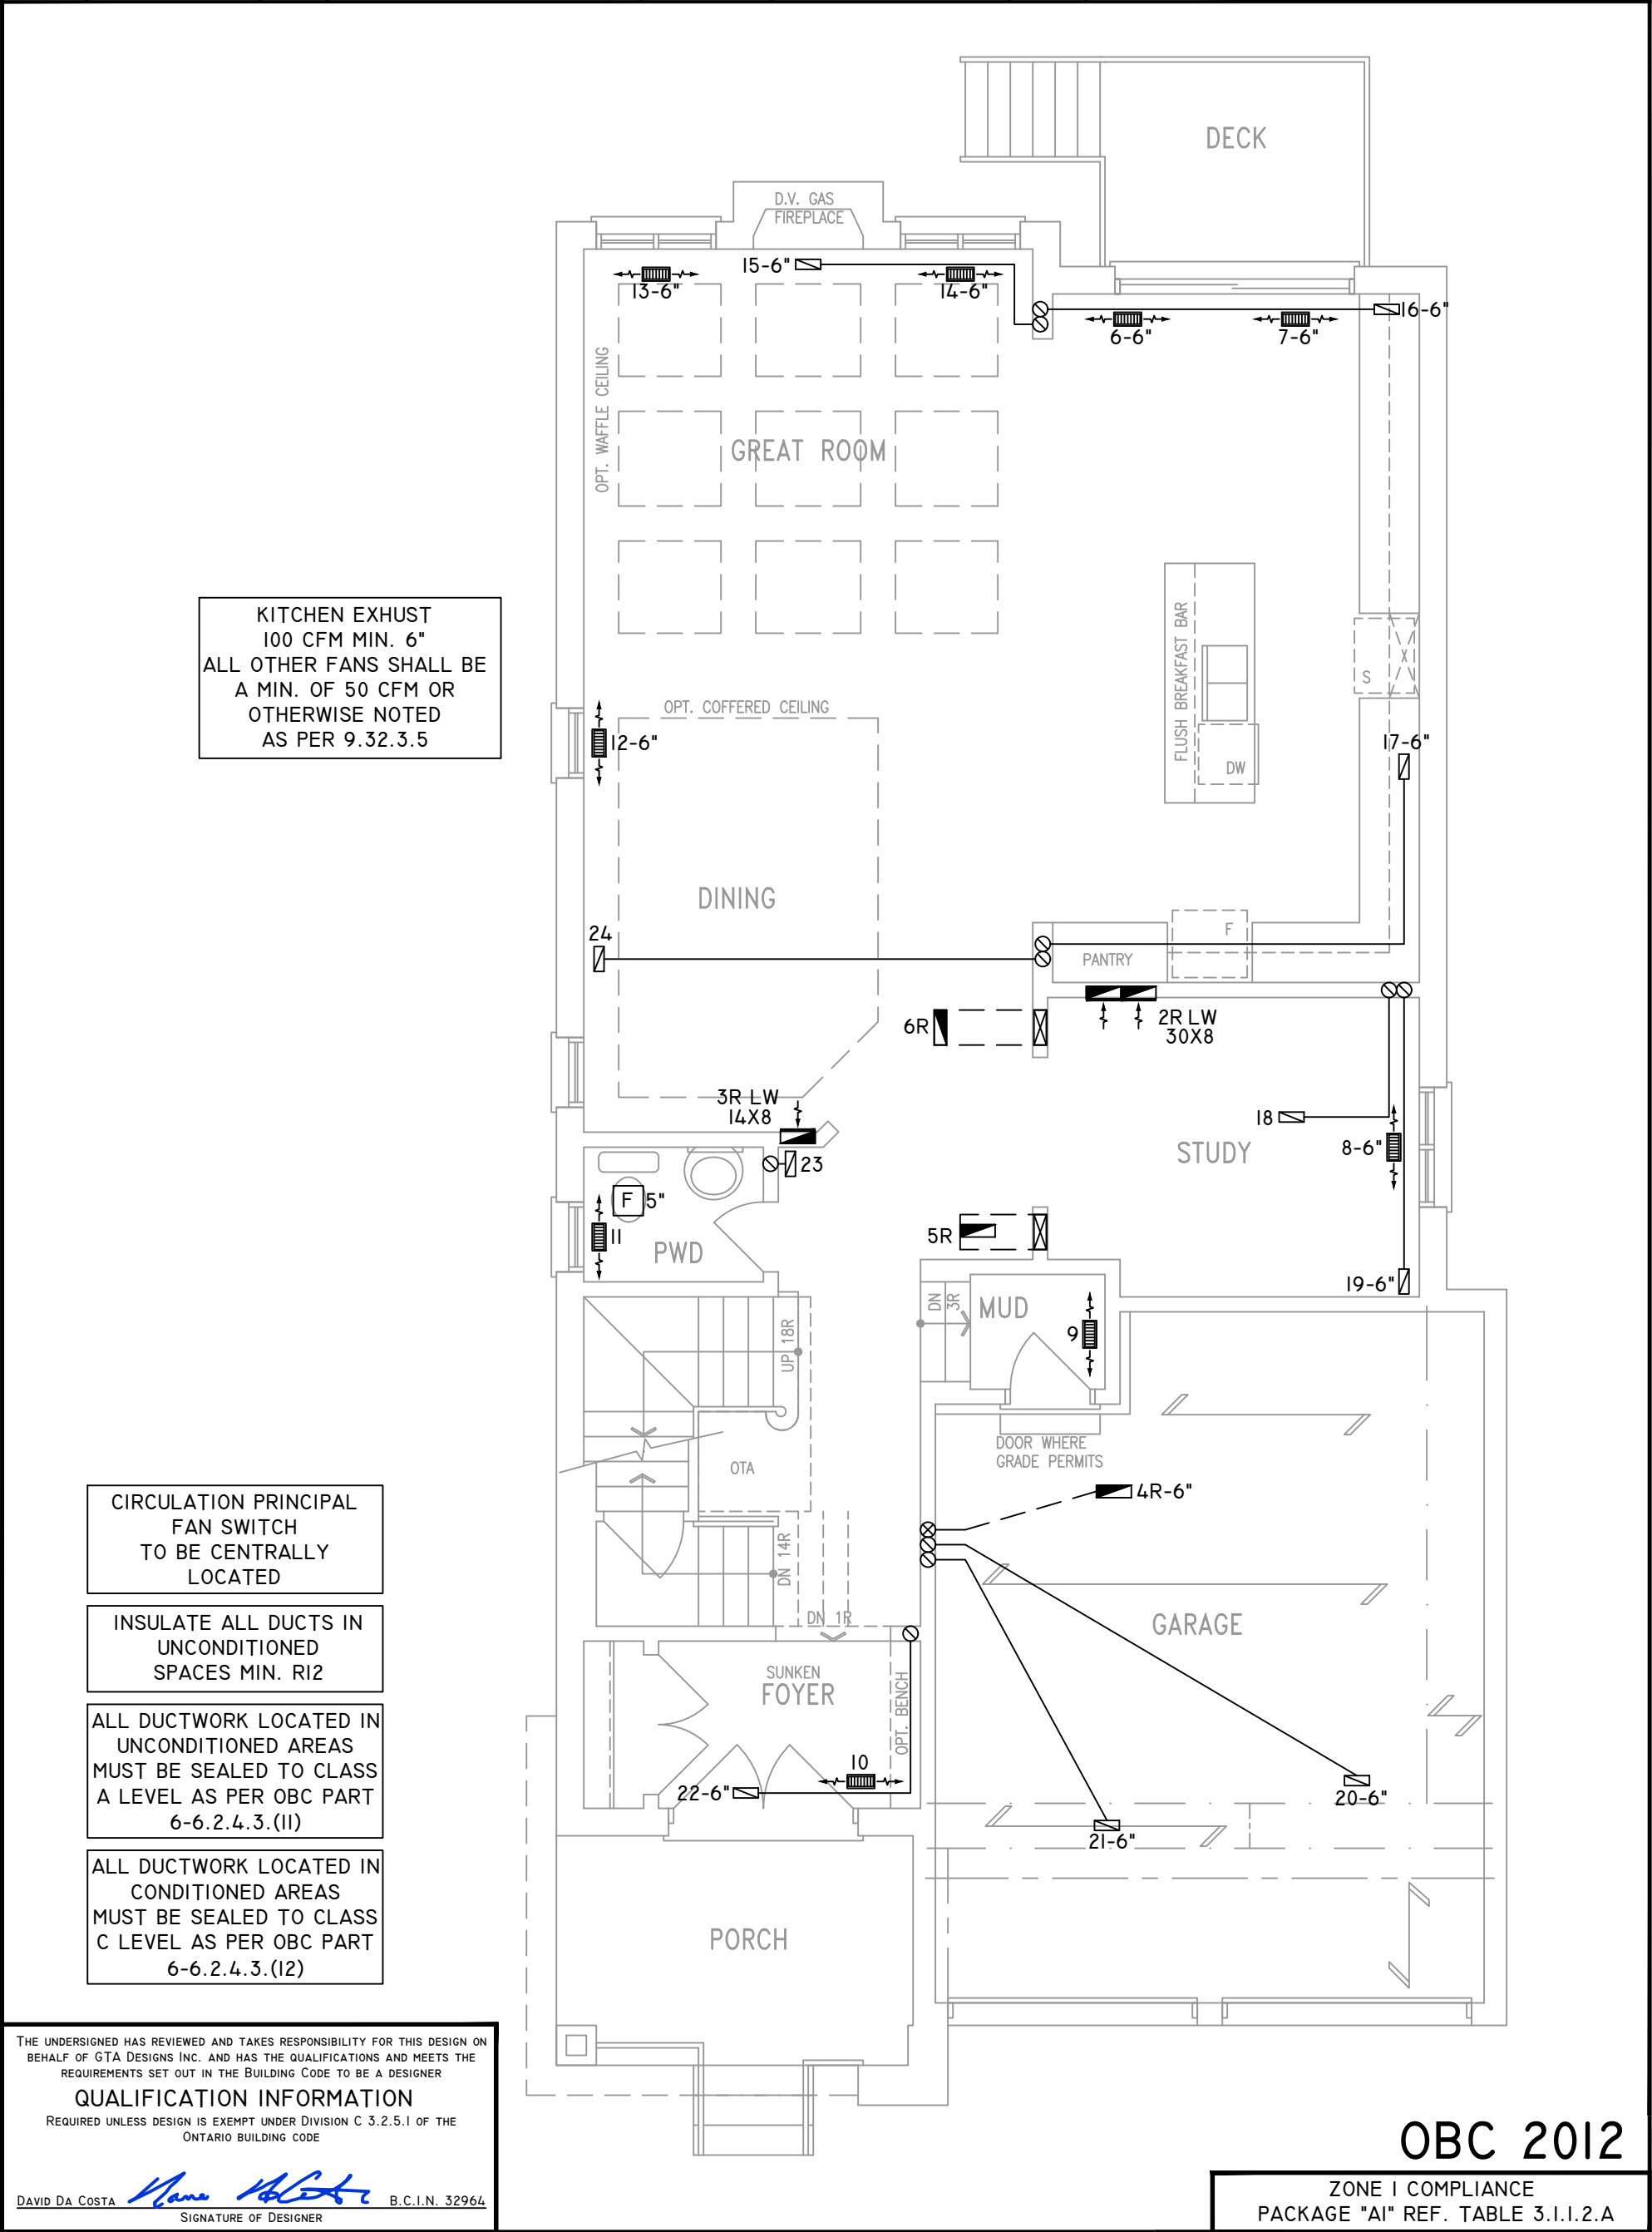
HEAT-LOSS	57,183	BTU/HR.
UNIT MAKE	AMANA	OR EQUAL.
UNIT MODEL	AMEC960803BNA	OR EQUAL.
UNIT HEATING INPUT	80,000	BTU/HR.
UNIT HEATING OUTPUT	76,800	BTU/HR.
A/C COOLING CAPACITY	2.5	TONS.
FAN SPEED	1172	CFM

# OF RUNS	S/A	R/A	FANS
3RD FLOOR			
2ND FLOOR	10	3	3
1ST FLOOR	9	2	2
BASEMENT	4	1	

FLOOR PLAN:	BASEMENT
DRAWN BY:	JL
CHECKED:	DD
LAYOUT NO.	JB-07270
SQFT	2889
DRAWING NO.	MI

DATE:	JUNE 25, 2021
CLIENT:	BAYVIEW WELLINGTON
MODEL:	S38-6 LOT 183 BAROSSA 6
PROJECT:	GREEN VALLEY EAST BRADFORD, ONT.
SCALE:	3/16" = 1'-0"

	FLEX DUCT		LOW/HIGH WALL/KICK SUPPLY DIFFUSER		DUCT CONNECTION TO JOIST LINING		RETURN AIR GRILLE (SIZE INDICATED ON DRAWING)	S.A.	SUPPLY AIR
	RIGID ROUND DUCT		HRV EXHAUST GRILLE		RETURN AIR PIPE RISER		RETURN AIR RISER UP TO FLOOR ABOVE	R.A.	RETURN AIR
	SUPPLY DIFFUSER		SUPPLY AIR PIPE RISER		RETURN ROUND DUCT		RETURN AIR FROM BASEMENT SECOND FLOOR		THERMOSTAT
			VOLUME DAMPER						PRINCIPAL EXHAUST FAN SWITCH
									W/R & PRINCIPAL EXHAUST FAN



NOTES

INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE.

ALL SUPPLY OUTLETS TO BE 5" DIA. UNLESS OTHERWISE SPECIFIED.

PROVIDE BALANCING DAMPERS ON ALL BRANCHES.

ALL R/A PARTITIONS 6" (FIRST FLOOR ONLY)

INSULATE DUCTS IN UNCONDITIONED SPACES R12 UNDERCUT ALL DOORS 1" MIN.

CONTRACTOR MUST WORK FROM APPROVED PLANS.

ANY ALTERATIONS TO THIS ORIGINAL PLAN ARE NOT THE RESPONSIBILITY OF GTA DESIGNS.

GTA DESIGNS MUST BE CONSULTED IF KITCHEN EXHAUST FAN EXCEEDS 700 CFM DEPRESSURIZATION MAY OCCUR WITH IN THE DWELLING.



2985 DREW ROAD
SUITE 202,
MISSISSAUGA, ONT.
L4T 0A4 TEL: 905-671-9800
EMAIL: DAVE@GTADESIGNS.CA
WEB: WWW.GTADESIGNS.CA

HEAT-LOSS	57,183	BTU/HR.
UNIT MAKE	AMANA	OR EQUAL.
UNIT MODEL	AMEC960803BNA	OR EQUAL.
UNIT HEATING INPUT	80,000	BTU/HR.
UNIT HEATING OUTPUT	76,800	BTU/HR.
A/C COOLING CAPACITY	2.5	TONS.
FAN SPEED	1172	CFM

# OF RUNS	S/A	R/A	FANS
3RD FLOOR			
2ND FLOOR	10	3	3
1ST FLOOR	9	2	2
BASEMENT	4	1	

FLOOR PLAN: GROUND FLOOR		
DRAWN BY: JL	CHECKED: DD	SQFT 2889
LAYOUT NO. JB-07270	DRAWING NO. M2	

DATE:	JUNE 25, 2021
CLIENT:	BAYVIEW WELLINGTON
MODEL:	S38-6 LOT 183 BAROSSA 6
PROJECT:	GREEN VALLEY EAST BRADFORD,ONT.
SCALE:	3/16" = 1'-0"

INSULATE ALL DUCTS IN UNCONDITIONED SPACES MIN. R12

ALL DUCTWORK LOCATED IN UNCONDITIONED AREAS MUST BE SEALED TO CLASS A LEVEL AS PER OBC PART 6-6.2.4.3.(11)

ALL DUCTWORK LOCATED IN CONDITIONED AREAS MUST BE SEALED TO CLASS C LEVEL AS PER OBC PART 6-6.2.4.3.(12)

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN ON BEHALF OF GTA DESIGNS INC. AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE BUILDING CODE TO BE A DESIGNER

QUALIFICATION INFORMATION

REQUIRED UNLESS DESIGN IS EXEMPT UNDER DIVISION C 3.2.5.1 OF THE ONTARIO BUILDING CODE

DAVID DA COSTA *David Da Costa* B.C.I.N. 32964

SIGNATURE OF DESIGNER

OBC 2012

ZONE I COMPLIANCE

PACKAGE "AI" REF. TABLE 3.1.1.2.A

NOTES

INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE.

ALL SUPPLY OUTLETS TO BE 5" DIA. UNLESS OTHERWISE SPECIFIED.

PROVIDE BALANCING DAMPERS ON ALL BRANCHES.

ALL R/A PARTITIONS 6" (FIRST FLOOR ONLY)

INSULATE DUCTS IN UNCONDITIONED SPACES R12 UNDERCUT ALL DOORS 1" MIN.

CONTRACTOR MUST WORK FROM APPROVED PLANS.

ANY ALTERATIONS TO THIS ORIGINAL PLAN ARE NOT THE RESPONSIBILITY OF GTA DESIGNS.

GTA DESIGNS MUST BE CONSULTED IF KITCHEN EXHAUST FAN EXCEEDS 700 CFM DEPRESSURIZATION MAY OCCUR WITH IN THE DWELLING.

GTADESIGNS

2985 DREW ROAD
SUITE 202,
MISSISSAUGA, ONT.

L4T 0A4 TEL: 905-671-9800
EMAIL: DAVE@GTADESIGNS.CA
WEB: WWW.GTADESIGNS.CA

HEAT-LOSS	BTU/HR.
57,183	
UNIT MAKE	OR EQUAL:
AMANA	
UNIT MODEL	OR EQUAL:
AMEC960803BNA	
UNIT HEATING INPUT	BTU/HR.
80,000	
UNIT HEATING OUTPUT	BTU/HR.
76,800	
A/C COOLING CAPACITY	TONS.
2.5	
FAN SPEED	CFM
1172	

# OF RUNS	S/A	R/A	FANS
3RD FLOOR			
2ND FLOOR	10	3	3
1ST FLOOR	9	2	2
BASEMENT	4	1	

FLOOR PLAN:

SECOND FLOOR

DRAWN BY:

DL

CHECKED:

DD

SQFT

2889

LAYOUT NO.

JB-07270

DRAWING NO.

M3

DATE:

JUNE 25, 2021

CLIENT:

BAYVIEW WELLINGTON

MODEL:

S38-6 LOT 183
BAROSSA 6

PROJECT:

GREEN VALLEY EAST
BRADFORD,ONT.

SCALE:

3/16" = 1'-0"