


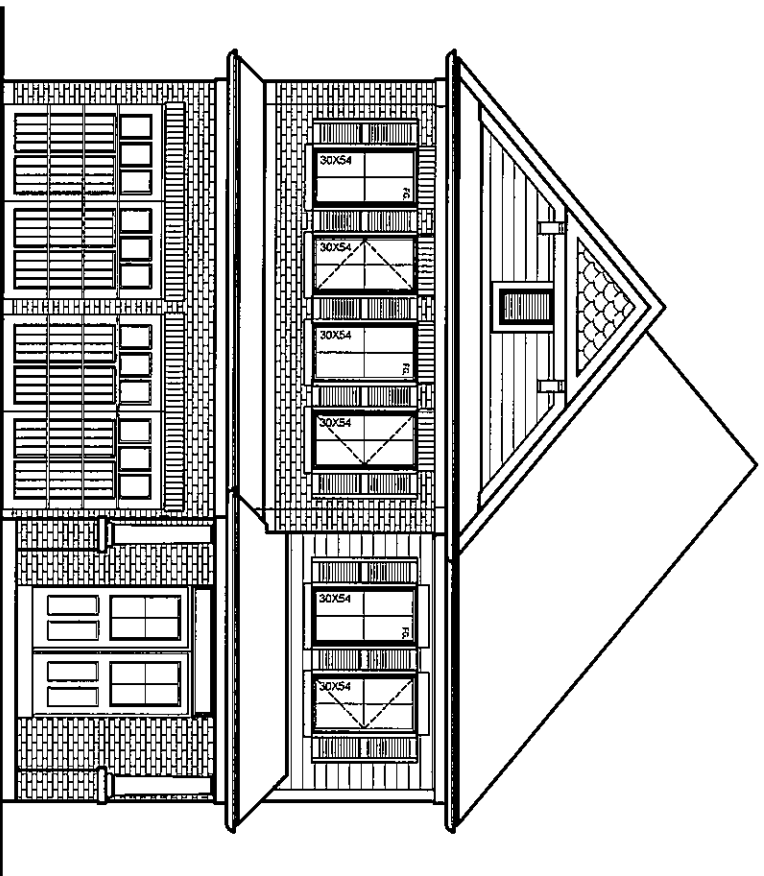

FRONT ELEVATION 'B'

GROSS GLAZING AREA ELEV. 'B'

TOTAL PERIPHERAL WALL AREA	2864.18 SF	266.08 m ²
FRONT GLAZING AREA	65.25 SF	6.06 m ²
LEFT SIDE GLAZING AREA	55.53 SF	5.16 m ²
RIGHT SIDE GLAZING AREA	32.19 SF	2.99 m ²
REAR GLAZING AREA	128.78 SF	11.95 m ²
TOTAL GLAZING AREA	281.75 SF	26.17 m ²
TOTAL GLAZING PERCENTAGE	9.84 %	

GROSS GLAZING AREA ELEV. 'B'
W/ OPT. PORCH & BALCONY

TOTAL PERIPHERAL WALL AREA	2864.18 SF	266.08 m ²
FRONT GLAZING AREA	65.25 SF	6.06 m ²
LEFT SIDE GLAZING AREA	55.53 SF	5.16 m ²
RIGHT SIDE GLAZING AREA	32.19 SF	2.99 m ²
REAR GLAZING AREA	144.33 SF	13.41 m ²
TOTAL GLAZING AREA	297.30 SF	27.62 m ²
TOTAL GLAZING PERCENTAGE	10.38 %	


OBC 2012

DRAWING LIST:

37-8 (HAMPTON) ELEV. 'B'

- T1 TITLE SHEET
- A1 BASEMENT FLOOR ELEV. 'B'
- A2 GROUND FLOOR ELEV. 'B'
- A3 SECOND FLOOR ELEV. 'B'
- A4 FRONT ELEVATION 'B'
- A5 RIGHT SIDE ELEVATION 'B'
- A6 REAR ELEVATION 'B'
- A7 REAR ELEVATION 'B'-W/ BALCONY
- A8 LEFT SIDE ELEVATION 'B'
- A9 PARTIAL PLANS ELEVATION 'B'
- A10 SIDE UPGRADE CONDITION
- A11 UPGRADED RIGHT SIDE ELEVATION 'B'
- A11 PARTIAL PLANS ELEVATION 'B'
- A12 WALKOUT BASEMENT CONDITION
- A12 UPGRADED REAR ELEVATION 'B'
- A12 WALKOUT BASEMENT CONDITION
- D1 CONSTRUCTION SHEET
- D2 CONSTRUCTION SHEET
- D3 CONSTRUCTION SHEET
- D4 TYPICAL SECTION

ESQUIRE HOMES
NORTHGLEN - PH. 2
CLARINGTON, ONTARIO



RN design
Imagine • Inspire • Create

8395 JANE STREET
SUITE 203
VAUGHAN, ON
TEL: 905-738-3177
FAX: 905-738-5449

CONTACT PERSON: NELSON CUNHA

No. REVISION COMMENTS:

1.	UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	-	NC
----	--------------------------------------	------------	---	----

No. REVISION COMMENTS:

		DATE	DWN	CHK
--	--	------	-----	-----

SCALE
AS NOTED

PROJECT No.
14093


THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS ARE SHOWN ON THE DRAWING.
TO COMMENCEMENT OF ANY WORK, ANY DISCREPANCIES
MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.
REVISED: JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J

I, NELSON CUNHA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN
RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LIMITED.
I AM QUALIFIED AND THE FIRM IS REGISTERED, IN THE APPROPRIATE
CLASSIFICATION CATEGORIES.


QUALIFIED DESIGNER BCIN: 21032
FIRM BCIN: 26995
DATE: OCTOBER 19, 2015

SIGNATURE:

T1

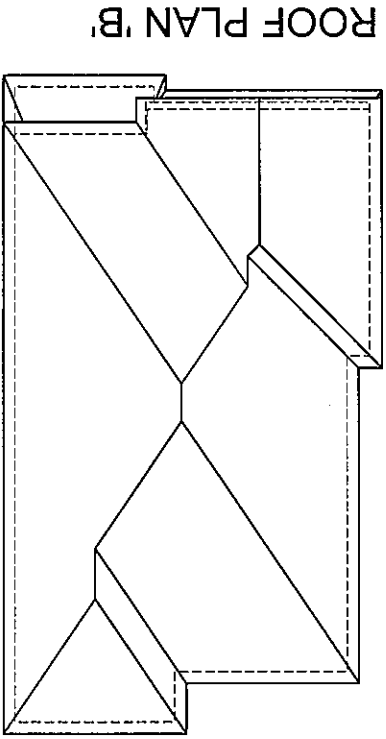

ROOF PLAN 'B'

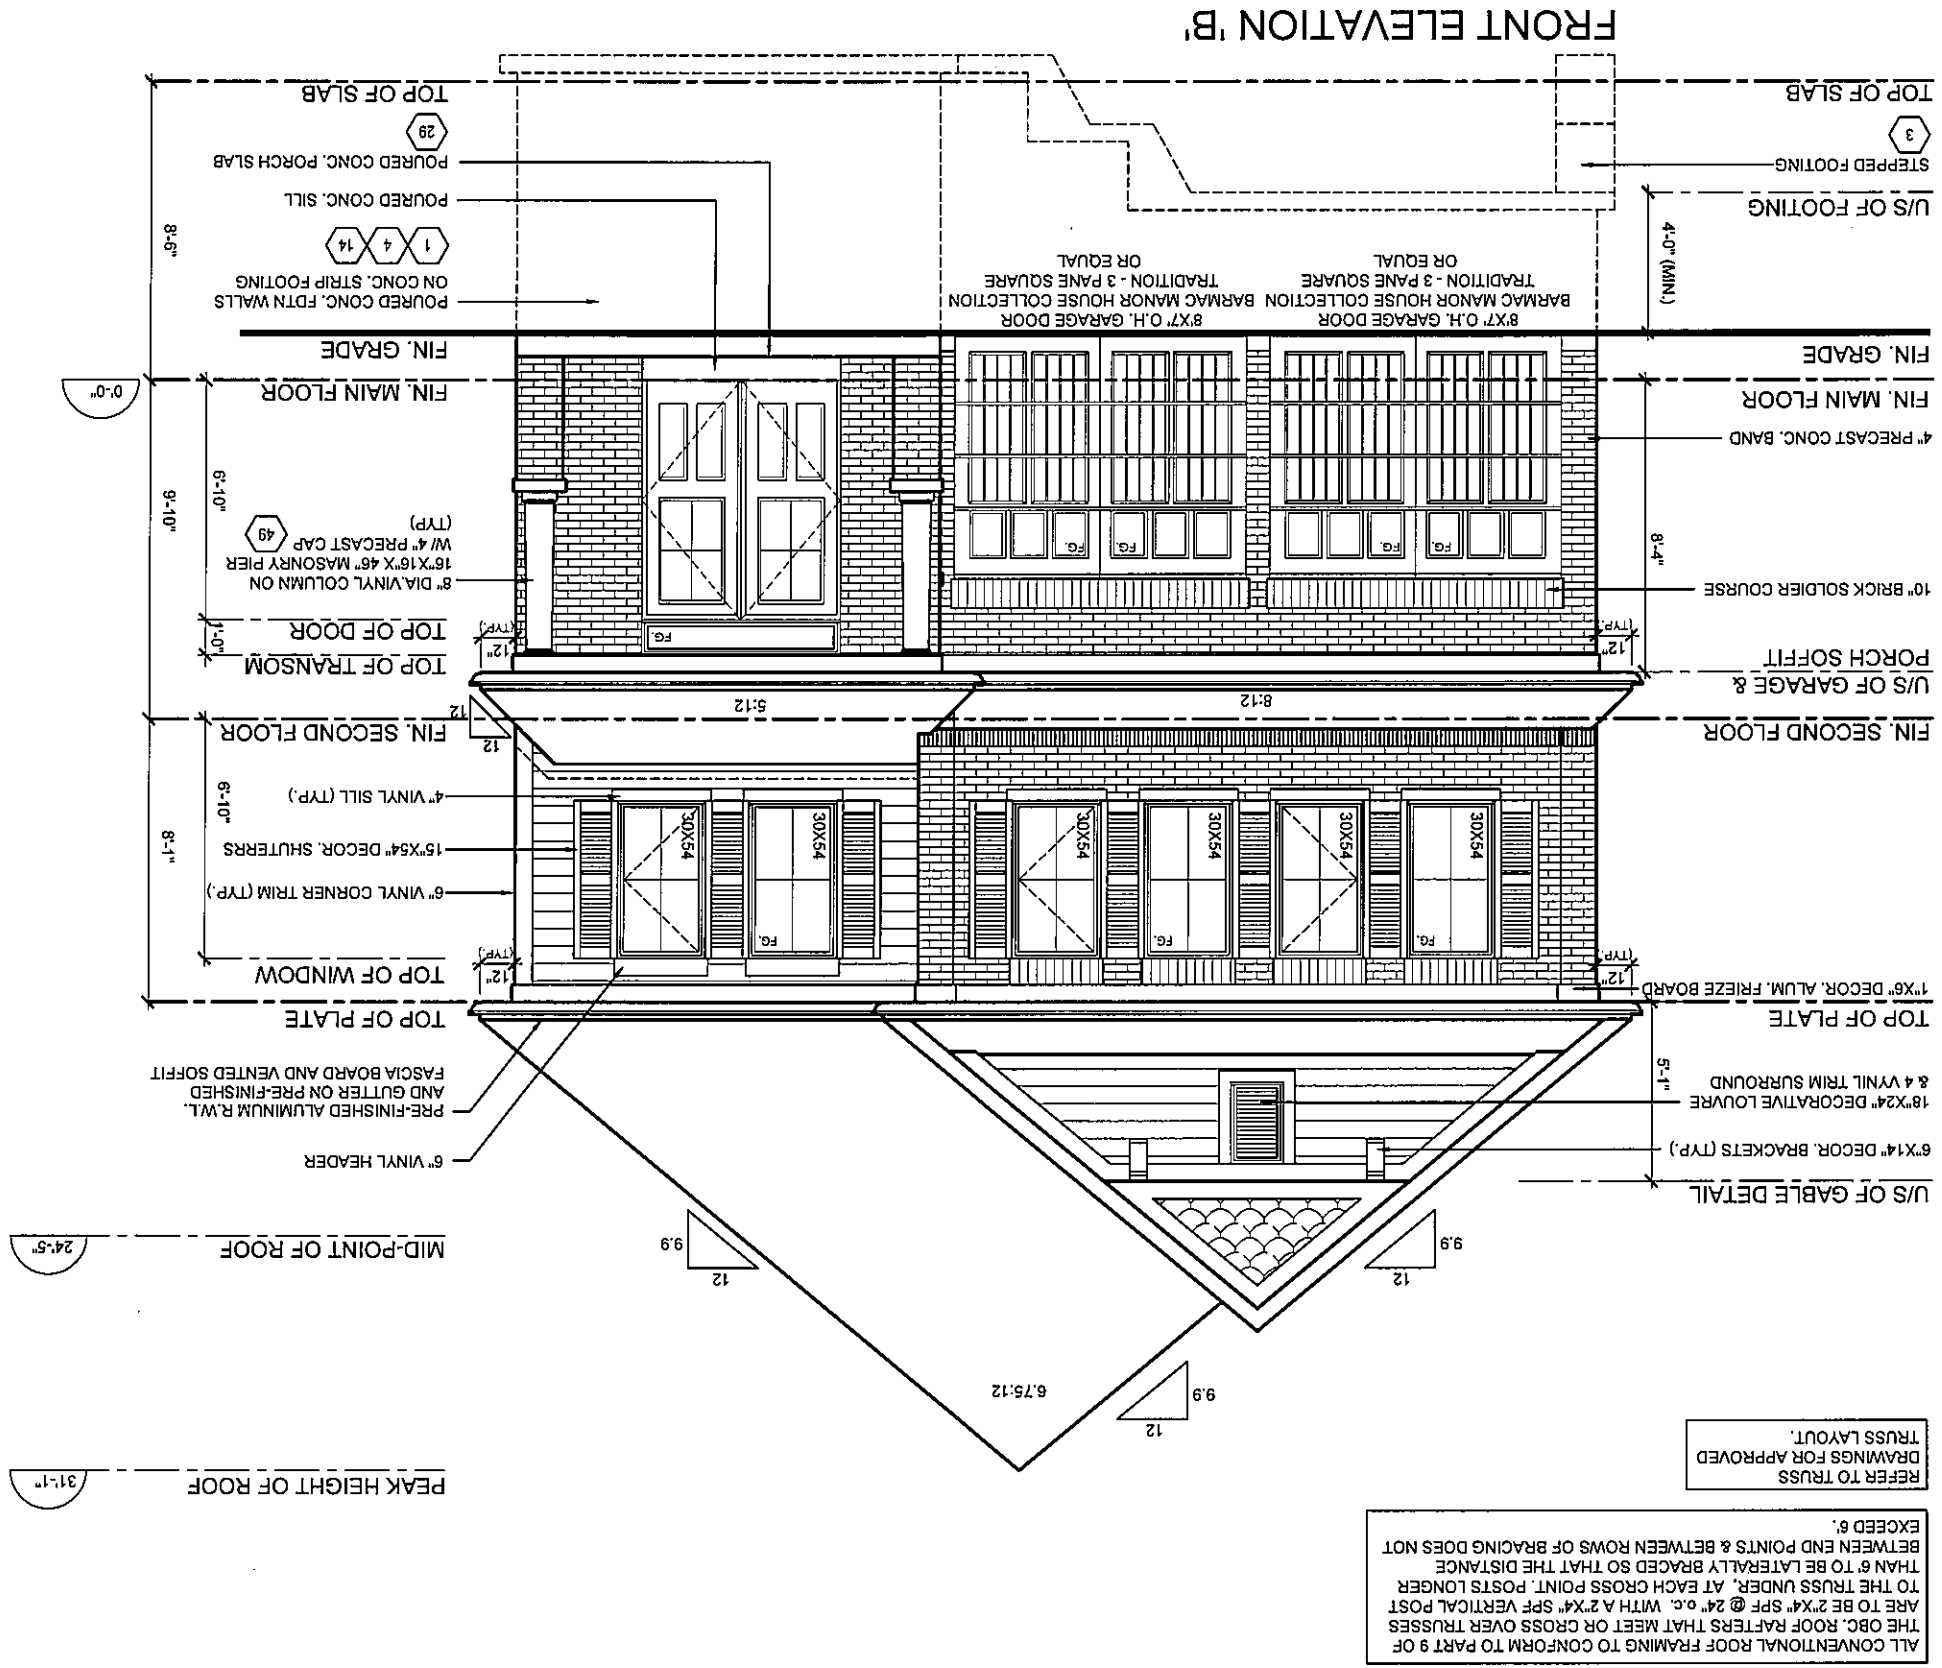

RN design
Imagine • Inspire • Create
TEL: (905) 738-3177
FAX: (905) 738-5449

ESQUIRE HOMES
NORTHGLEN - PHASE 2
CLARINGTON, ONTARIO

MODEL 37-8 (HAMPTON) ELEV. 'B'

CLIENT

No. ISSUED OR REVISION COMMENTS
1. UPDATED TO OBC 2012 - 2015 ENACTMENT

DATE DWN CHK
OCT. 19/15 - NC


SCALE 3/16" = 1'0"
PROJECT NUMBER 14093

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.
REVISED: JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO SR-12 COMPLIANCE PACKAGE 2 CLASSIFICATION CATEGORIES.

DESIGNER'S DECLARATION: I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN OF THIS PROJECT.
FIRM BCIN: 28995
DATE: OCTOBER 19, 2015

SIGNATURE:

A4

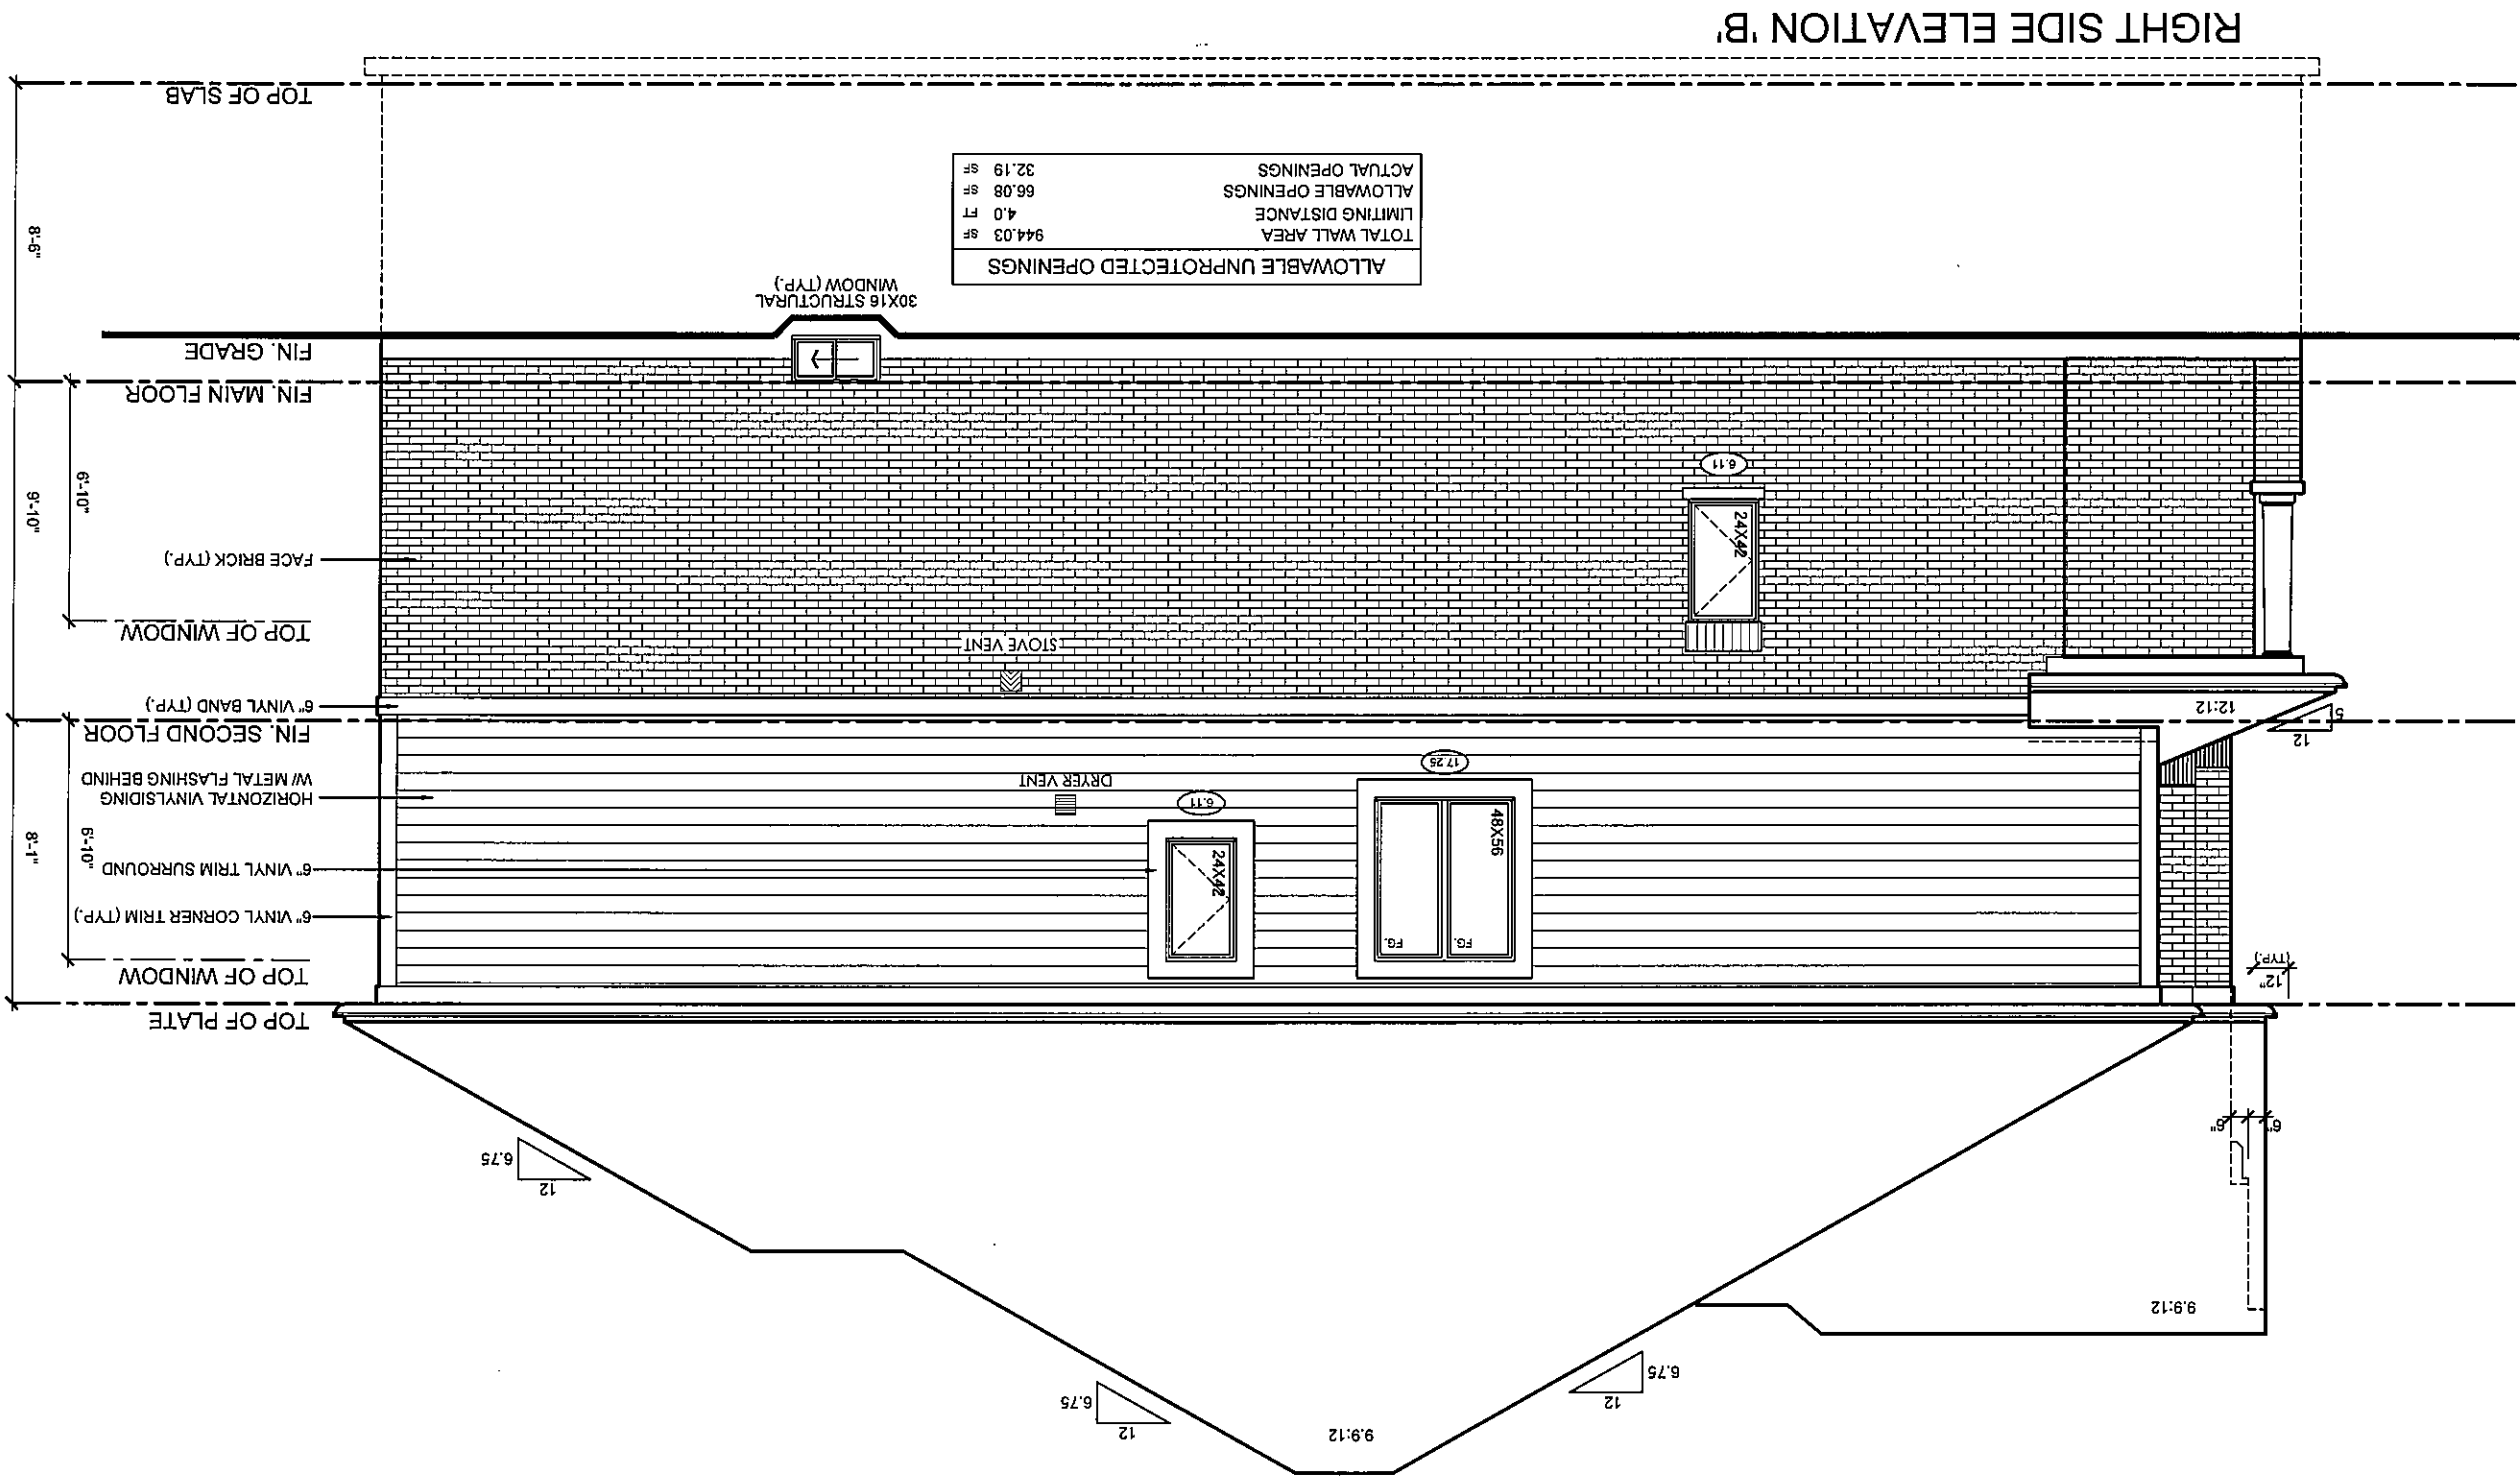

RN design
Imagine • Inspire • Create
TEL: (905) 738-3177
FAX: (905) 738-5449


ESQUIRE HOMES
NORTHGLEN - PHASE 2
CLARINGTON, ONTARIO

MODEL	37-8 (HAMPTON) ELEV. 'B'	No.	ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE
CLIENT		1.	UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	-	NC	3/16" = 1'0"
							PROJECT NUMBER
							14093
							PAGE
							A5

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR
TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES
MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.
REVISED: JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J

I, REGINA GUNIA, DESIGNER, HAVE REVIEWED AND TAKE DESIGN
RESPONSIBILITY FOR THESE DRAWINGS. I AM A REGISTERED
UNDER DIVISION C, PART 3, SUBSECTION 32.4, OF THE BUILDING CODE.
I AM QUALIFIED AND THE FIRM IS REGISTERED, IN THE APPROPRIATE
CLASSIFICATION CATEGORY.


QUALIFIED DESIGNER BCIN: 21032
FIRM BCIN: 26995
DATE: OCTOBER 19, 2015
SIGNATURE:

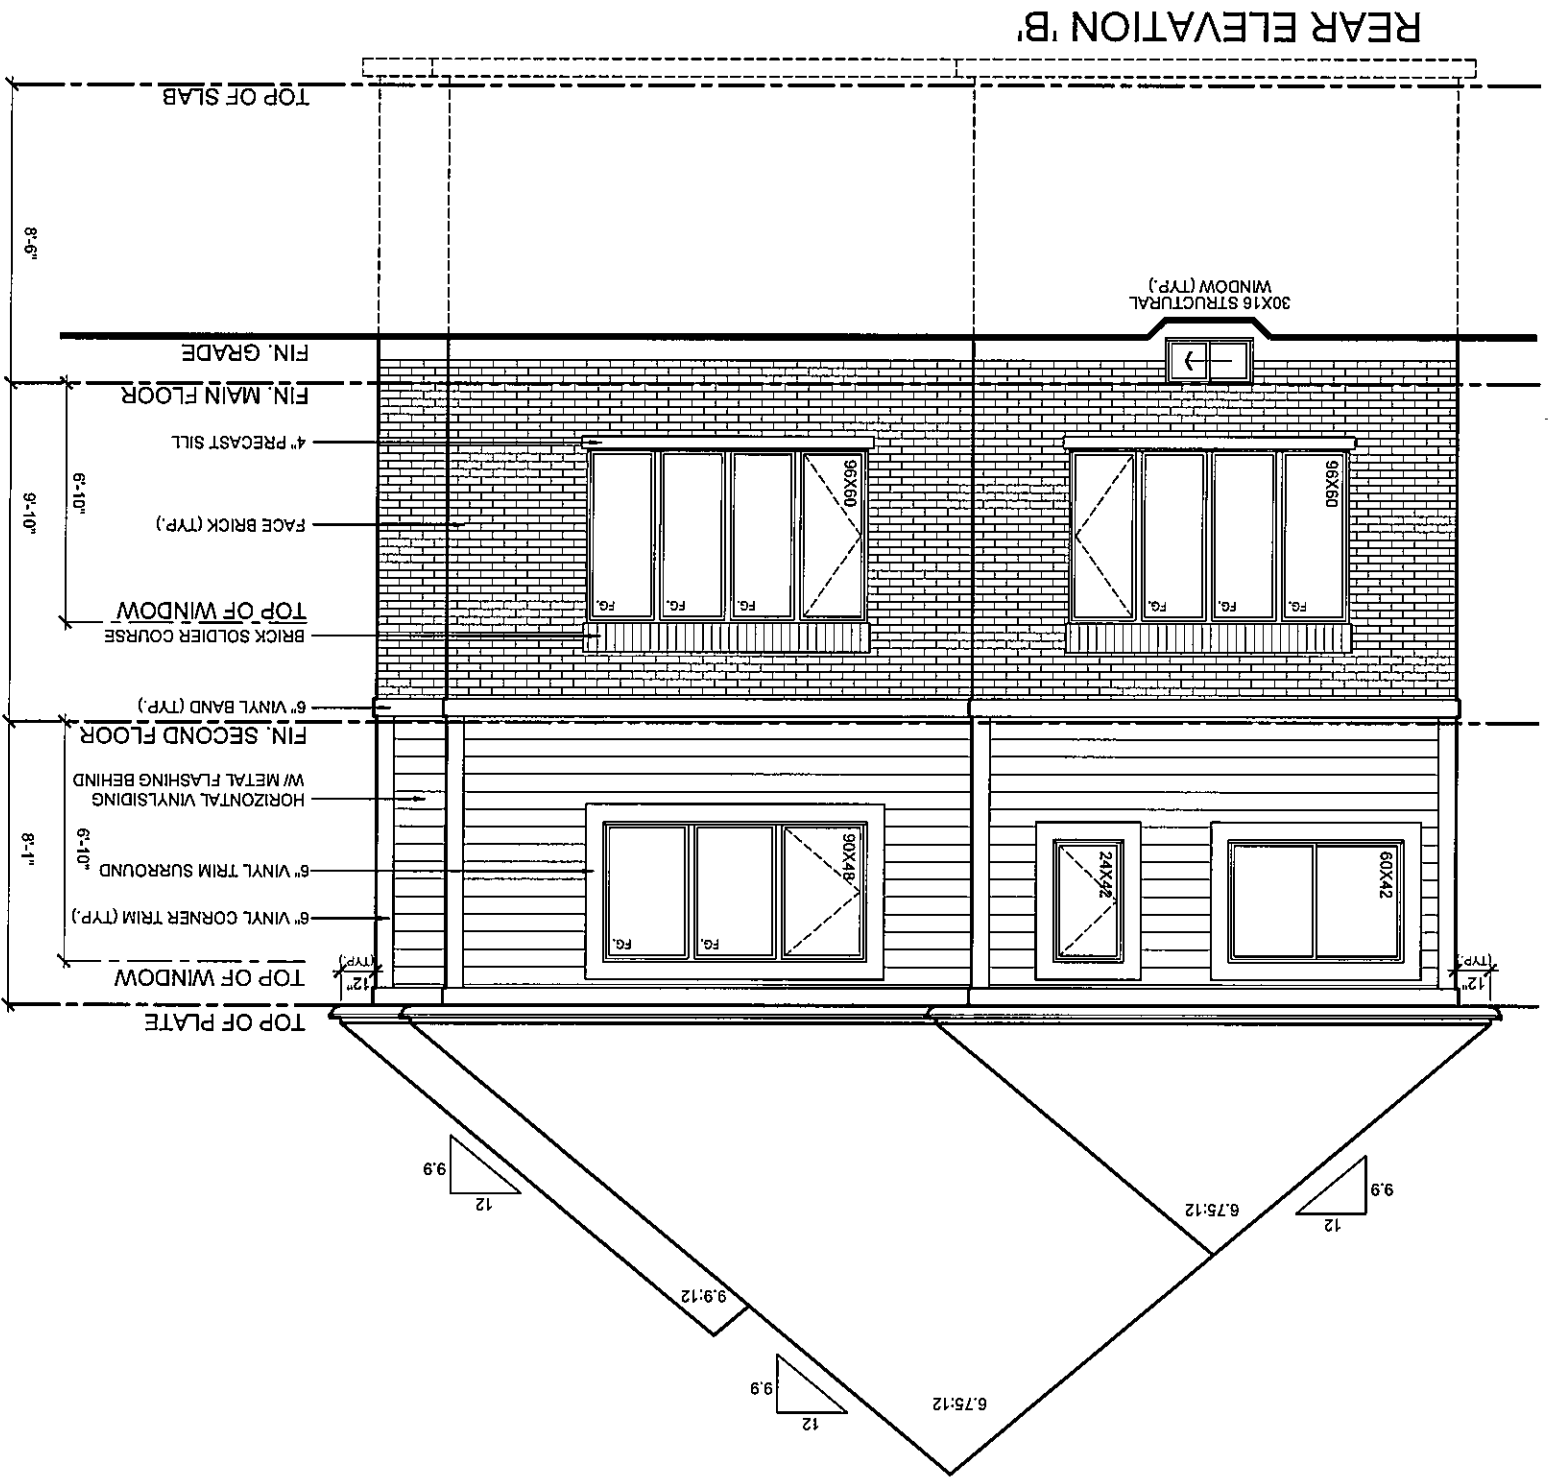

RN design
Imagine • Inspire • Create
TEL: (905) 738-3177
FAX: (905) 738-5448

MODEL		37-8 (HAMPTON) ELEV. 'B'		SCALE	
CLIENT		ESQUIRE HOMES NORTHGLEN - PHASE 2 CLARINGTON, ONTARIO		PROJECT NUMBER	
				14093	

THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD. REVISED: JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J		I, DESIGNER SIGN, DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE ACCURACY OF THESE DRAWINGS. UNDER DIVISION C, PART 3, SUBSECTION 3.2.4, OF THE BUILDING CODE - CLASSIFICATION: THEORETICAL.		QUALIFIED DESIGNER BCIN: 21032 FIRM BCIN: 28995 DATE: OCTOBER 19, 2015		SIGNATURE:	

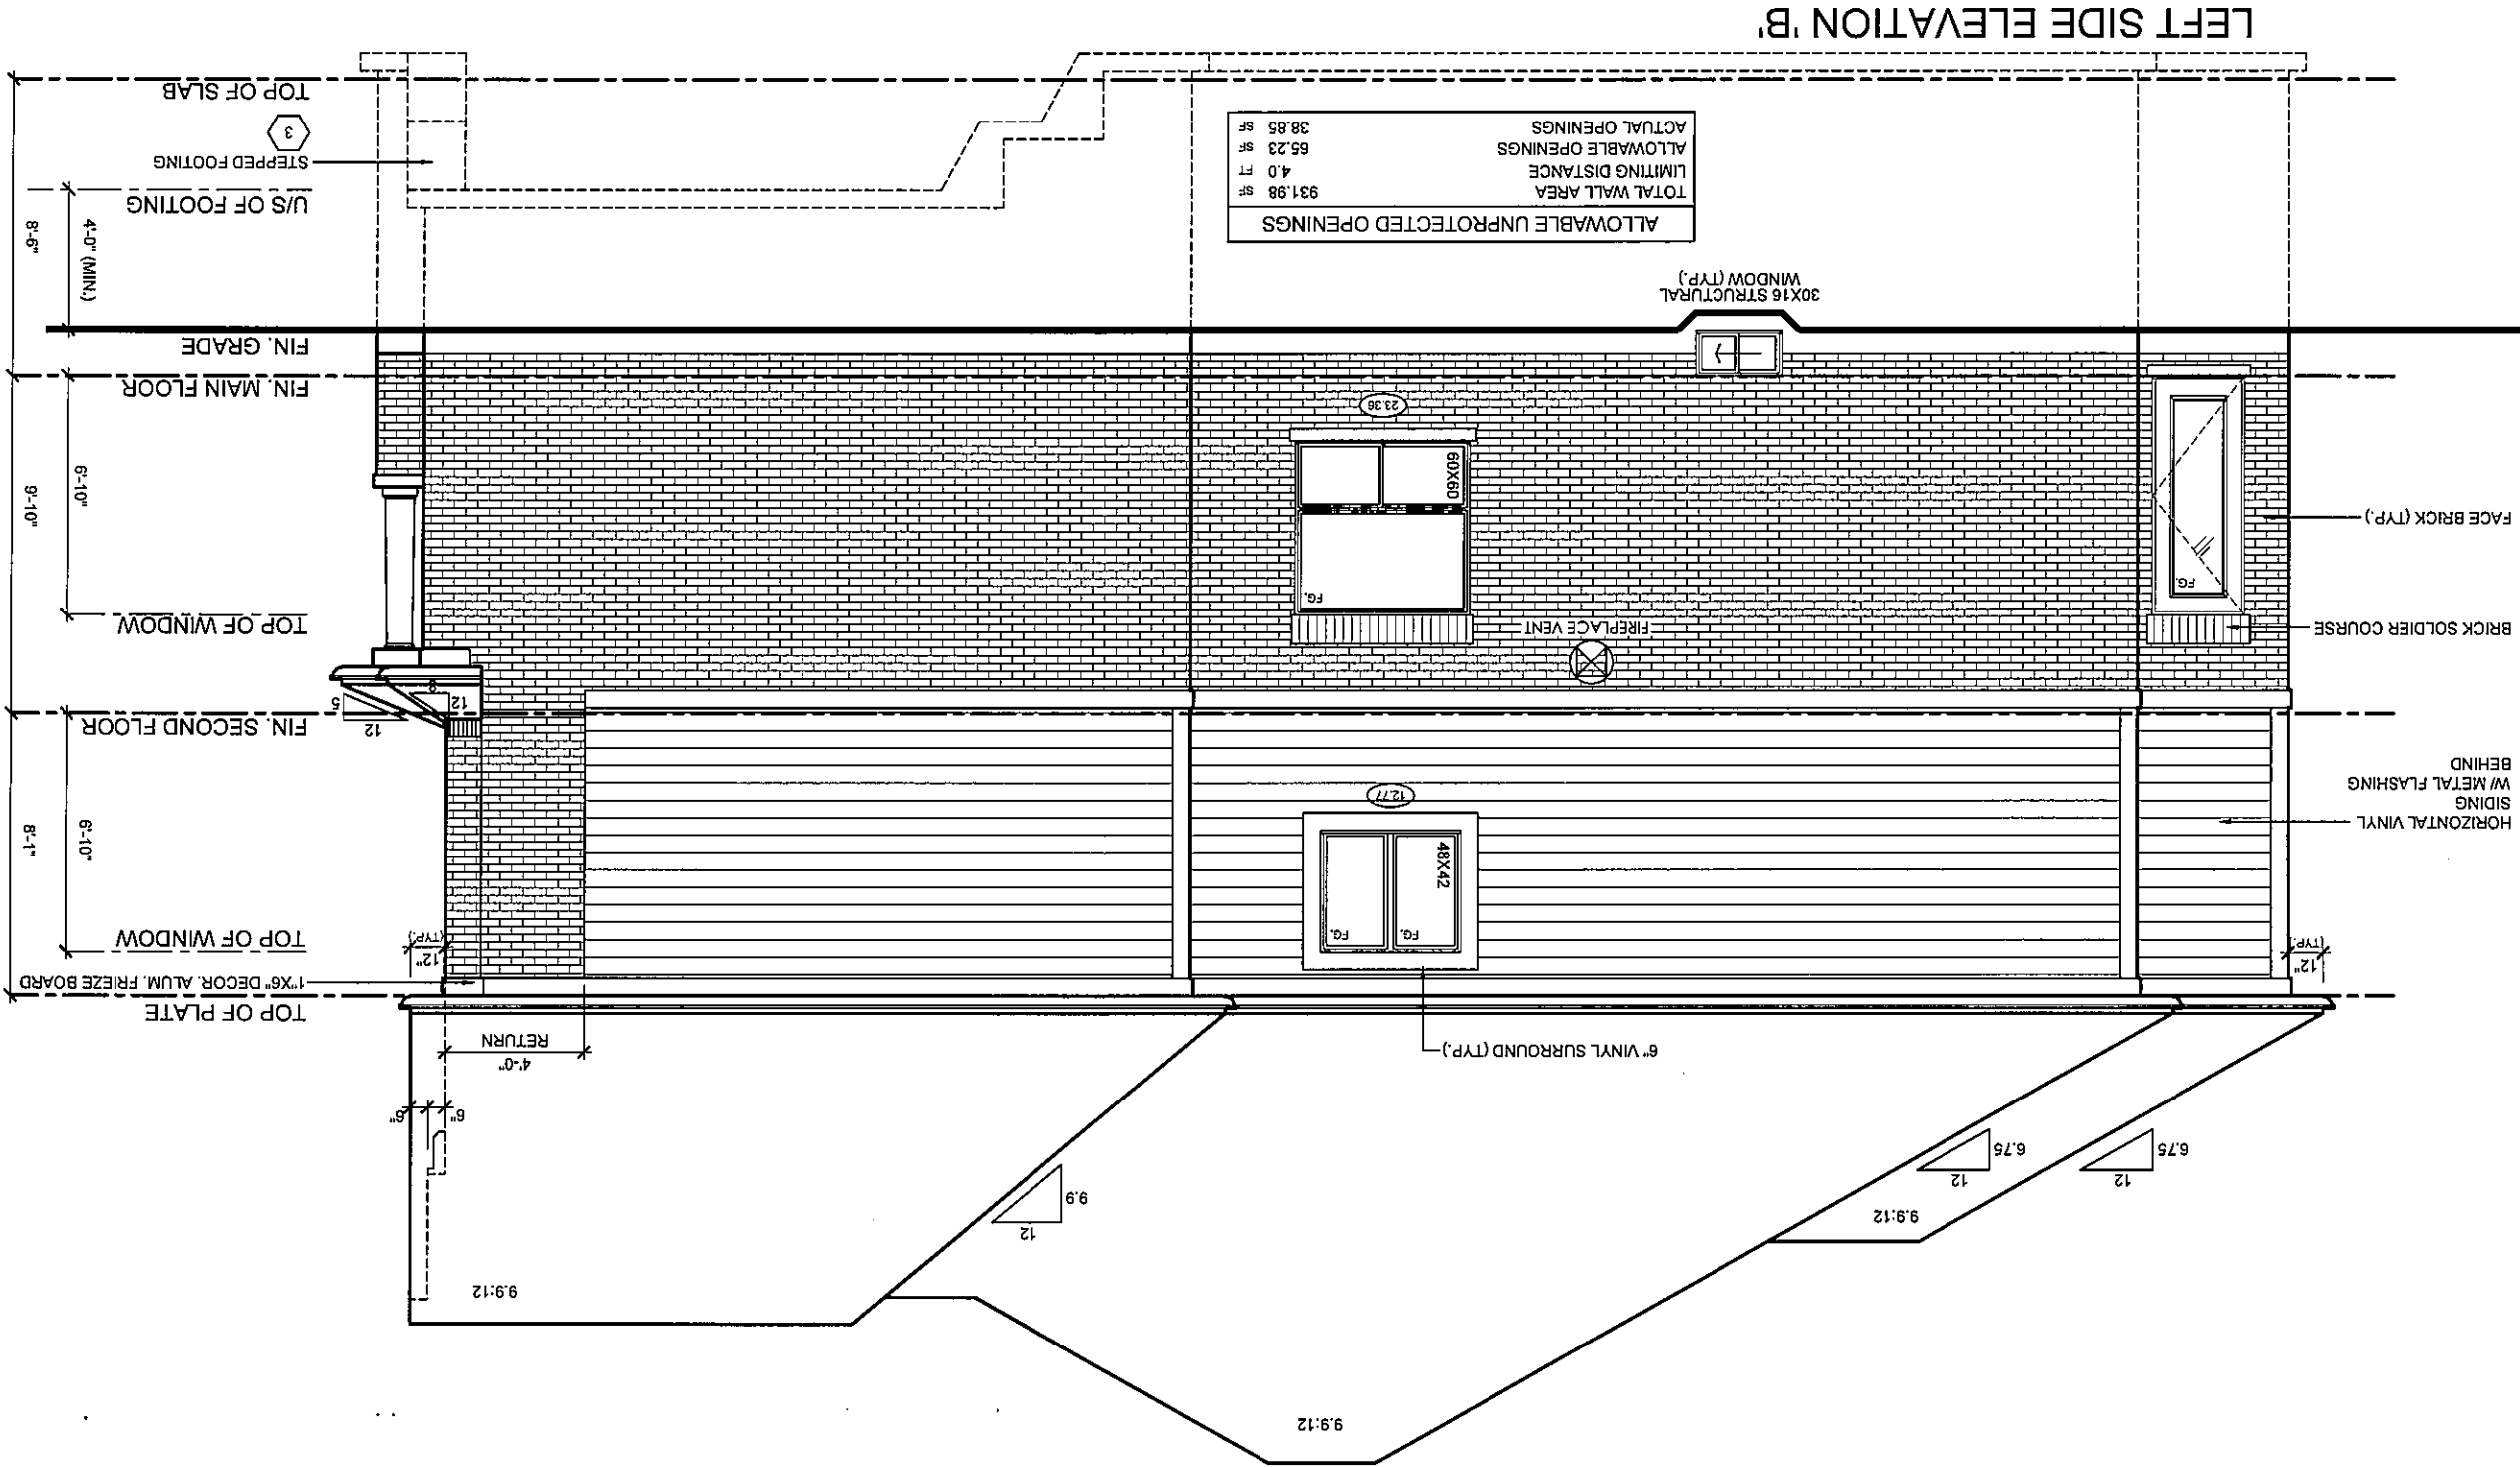

RN design
Imagine - Inspire - Create
TEL: (905) 738-3177
FAX: (905) 738-6449

ESQUIRE HOMES
NORTHGLEN - PHASE 2
CLARINGTON, ONTARIO

MODEL
37-8 (HAMPTON) ELEV. 'B'

CLIENT

No.	ISSUED OR REVISION COMMENTS	DATE	DWN	CHK
1.	UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	-	NC

SCALE
3/16" = 1'0"
PROJECT NUMBER
14093


PAGE

A8

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.
REVISED: JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO 98-12 COMPLIANCE PACKAGE J

I, NERSON CHINA, DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE FOLLOWING DRAWING.
I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSIFICATION CATEGORY.

QUALIFIED DESIGNER BCIN: 21032
FIRM BCIN: 26995
DATE: OCTOBER 19, 2015
SIGNATURE:

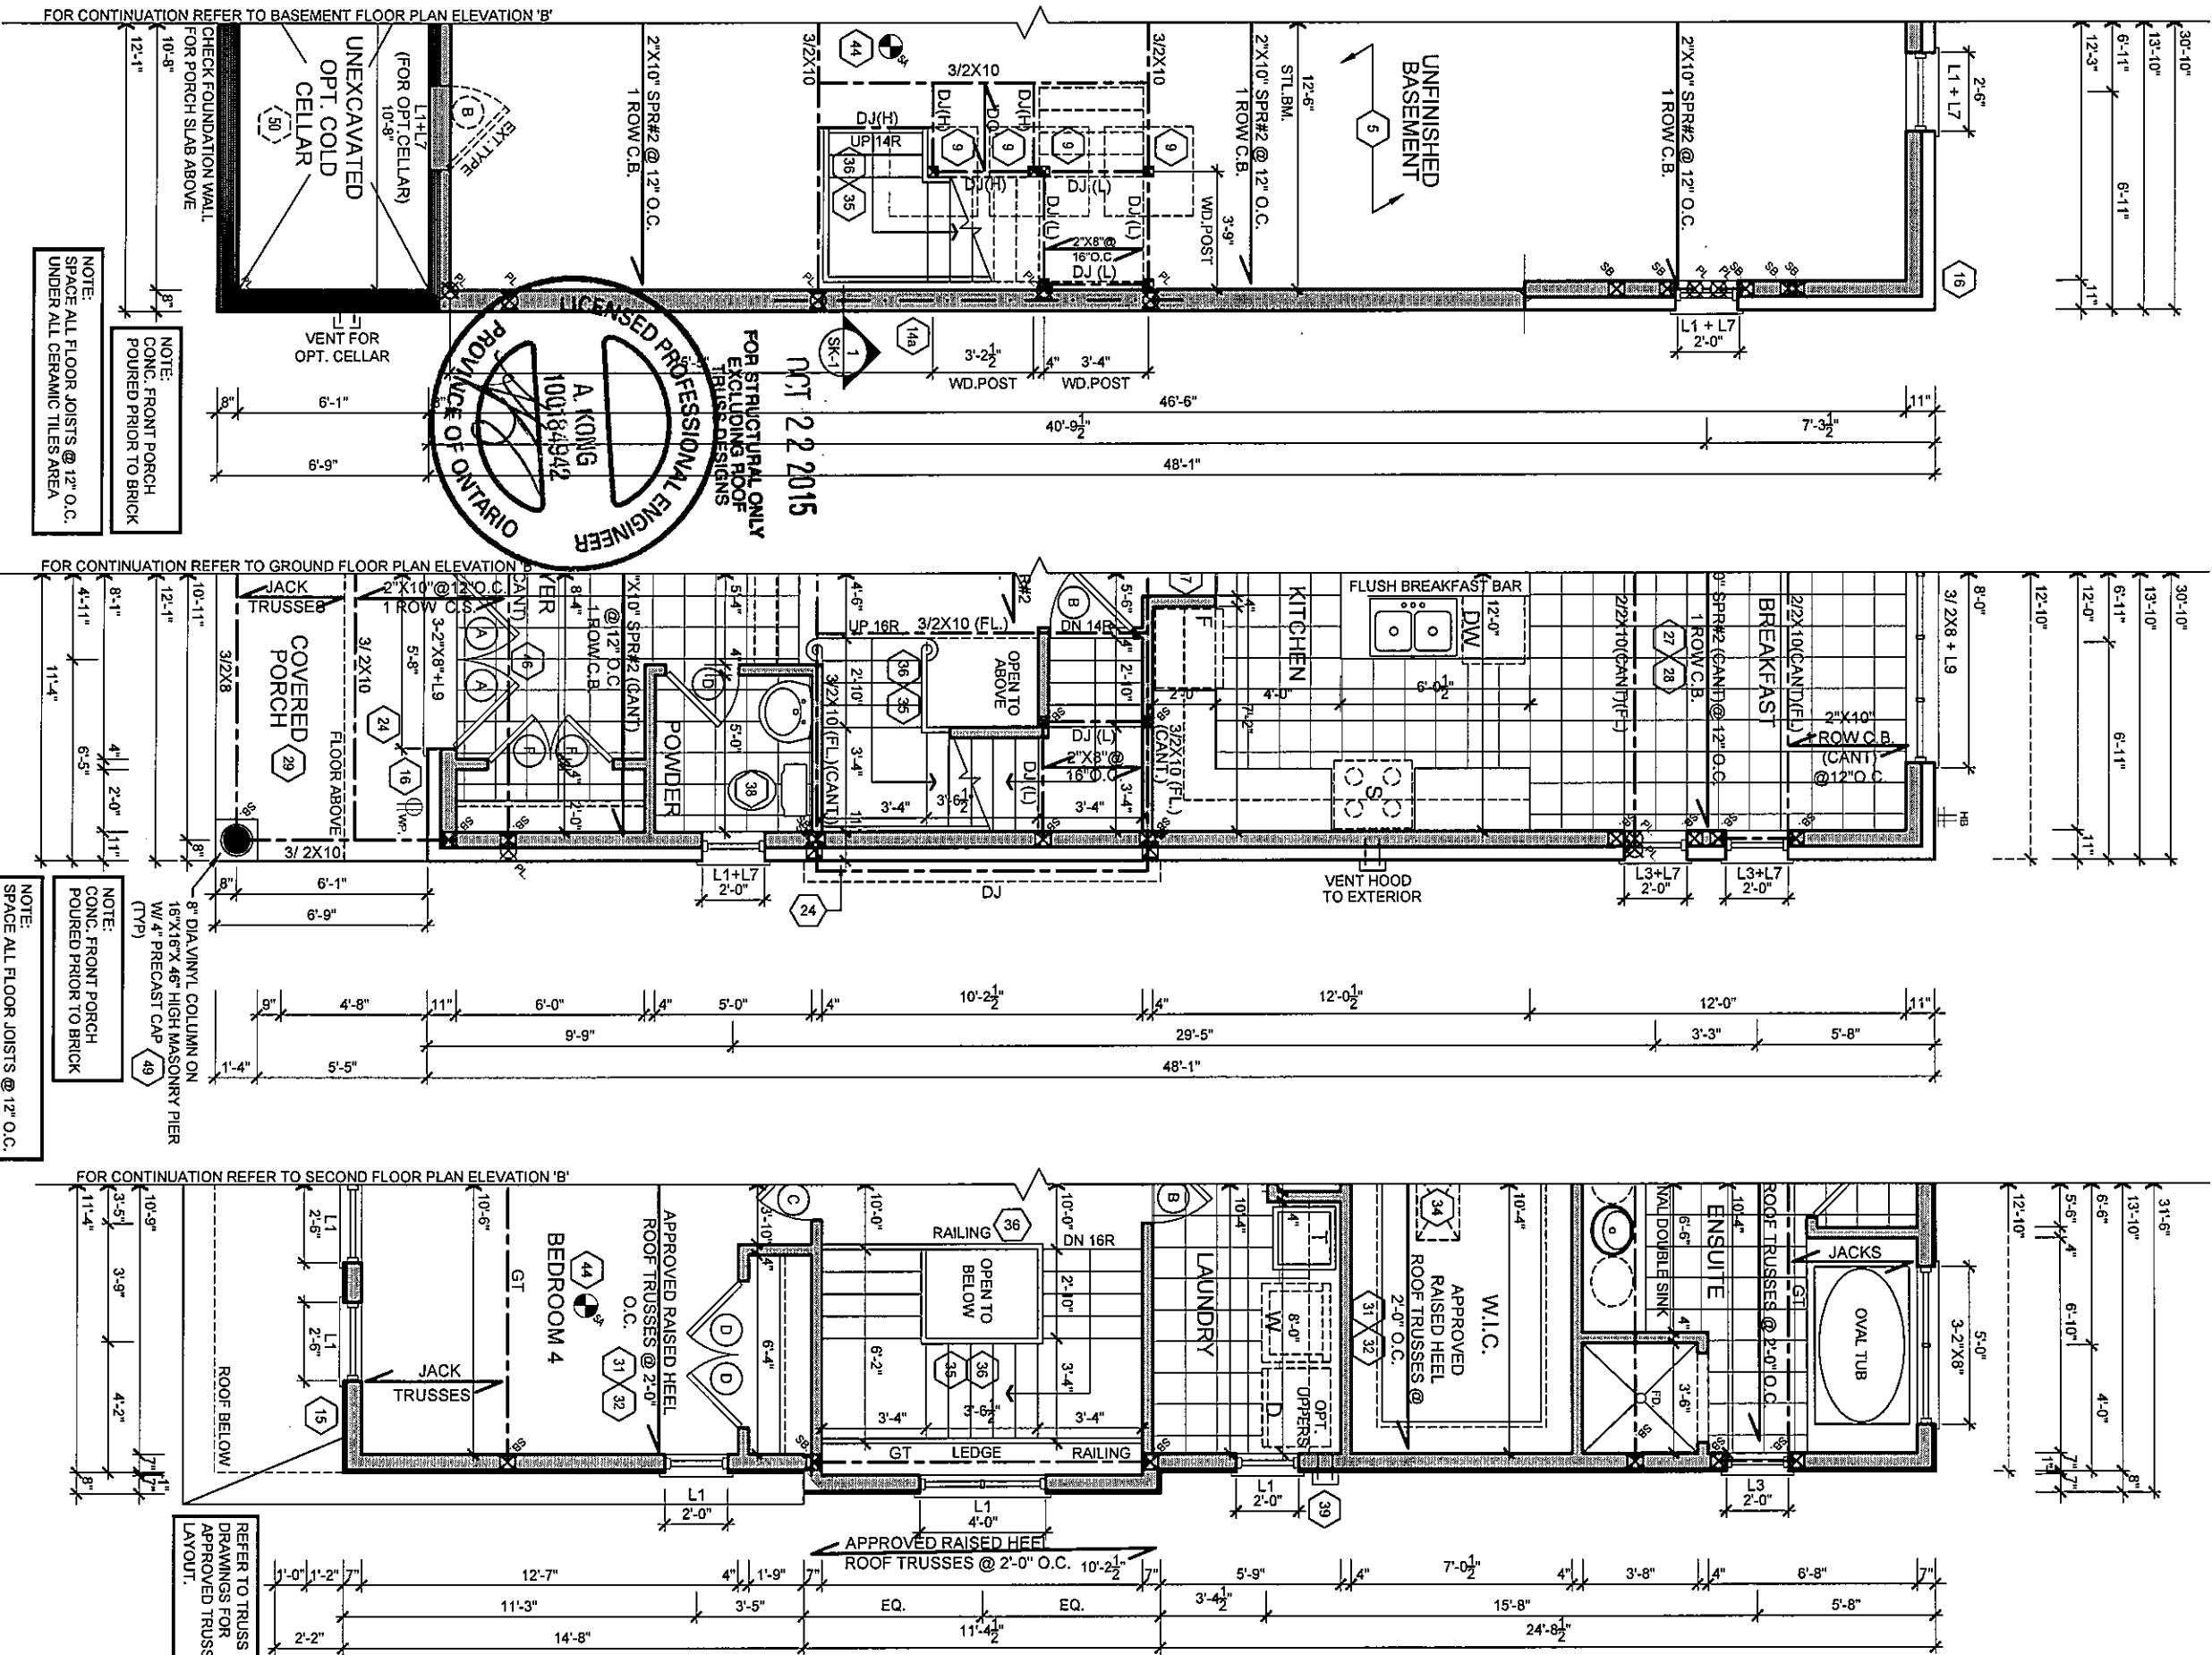

PARTIAL
BASEMENT FLOOR ELEV. 'B'
SIDE UPGRADE CONDITION

PARTIAL
GROUND FLOOR ELEV. 'B'
SIDE UPGRADE CONDITION

PARTIAL
SECOND FLOOR ELEV. 'B'
SIDE UPGRADE CONDITION



RN design
Imagine • Inspire • Create
TEL: (905) 738-3177
FAX: (905) 738-5449

CLIENT

ESQUIRE HOMES
NORTHGLEN - PHASE 2
CLARINGTON, ONTARIO

MODEL

37-8 (HAMPTON) ELEV. 'B'

No.	ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE
1.	UPDATED TO DEC 2012 - 2015 ENACTMENT	OCT. 19/15	-	NC	3/16" = 1'0"

QUALIFIED DESIGNER BCIN: 21032
FIRM BCIN: 28995
DATE: OCTOBER 19, 2015

SIGNATURE:

PROJECT NUMBER

14093

PAGE


A9

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.
REVISED JANUARY 08, 2013 - RN STAFF IN ACCORDANCE TO SPS-12 COMPLIANCE PACKAGE 1

NELSON GUNDA DECLARES THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DRAWINGS AND THE INFORMATION CONTAINED HEREIN. I AM A QUALIFIED PROFESSIONAL ENGINEER AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSIFICATION CATEGORIES.

[illegible]

PARTIAL
GROUND FLOOR ELEV. 'B'
WALKOUT BASEMENT CONDITION

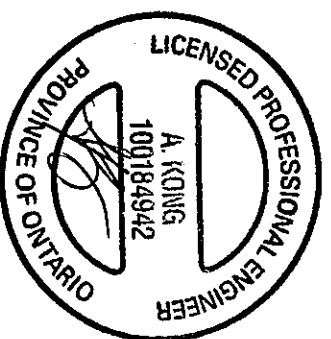

30'-10"

2'-0"

8'-0"

14'-1"

7'-0"

6'-11"


12'-0"

6'-1"

1'-1"

1'-1"

4" x 4" POSTS @ 47' O.C. MAX.
ATTACHED TO JOISTS AS PER
S8-7 SUPPLEMENTRY
GUIDELINES TO THE OBC

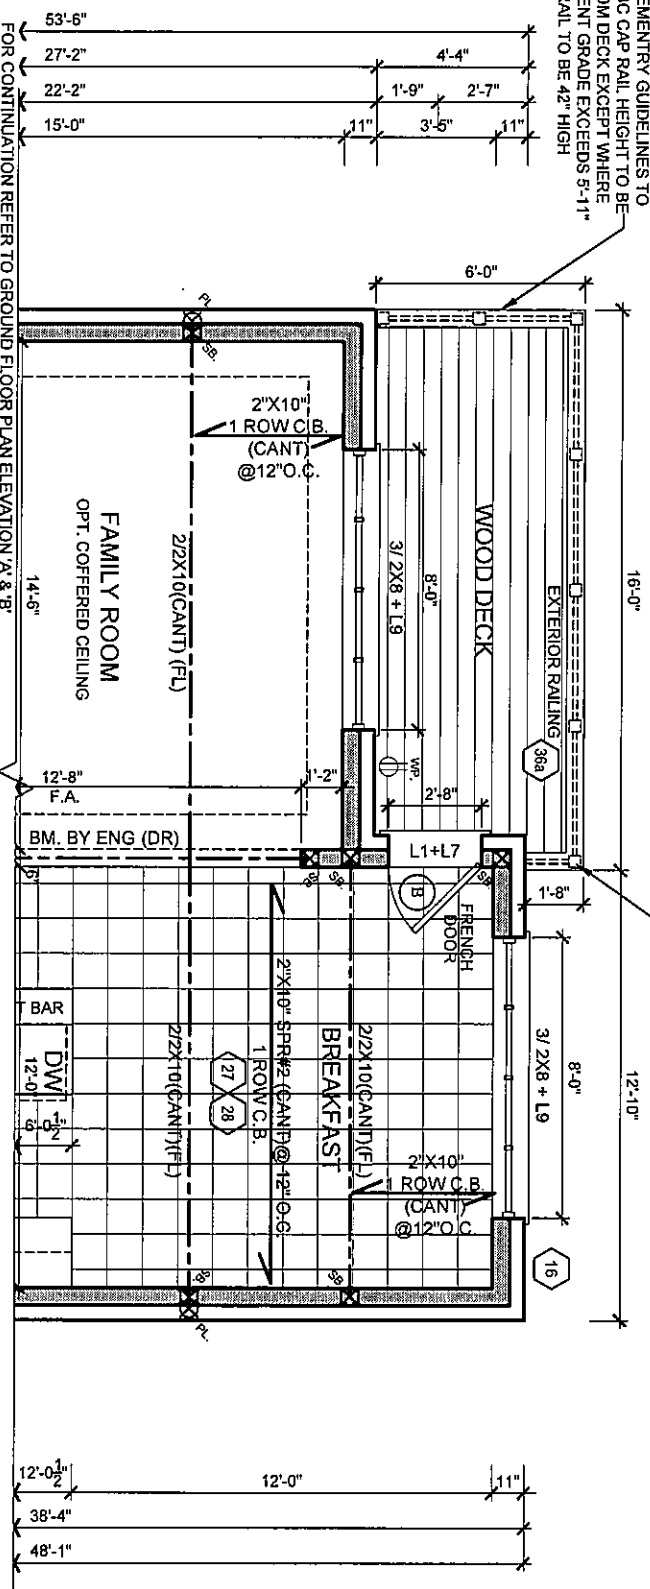

ESQUIRE HOMES
NORTHGLEN - PHASE 2
CLARINGTON, ONTARIO

[illegible]

I, NELSON CUNHA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RM DESIGN LIMITED UNDER DIVISION C, PART 3, SUBSECTION 3.2.4. OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE	QUALIFIED DESIGNER BCIN: 21032	SIGNATURE
	FIRM BCIN: 26995	

QUALIFIED DESIGNER BCIN:	21032
FIRM BCIN:	26995

A1

CONSTRUCTION NOTES:

COMPLIANCE PACKAGE J - O.B.C. 2012 - 2015 ENACTMENT

(UNLESS OTHERWISE NOTED)
-ALL CONSTRUCTION TO CONFORM TO THE ONTARIO BUILDING CODE (O.B.C.) AND ALL OTHER CODES AND LOCAL AUTHORITIES HAVING JURISDICTION.
-ALL DIMENSIONS GIVEN FIRST IN IMPERIAL FOLLOWED BY METRIC.
-THERMAL RESISTANCE VALUES BASED ON ZONE 1

FOOTINGS / SLABS:

TYPICAL STRIP FOOTING:

O.B.C. 9.15.3.

-BASED ON 16-1/4" (9mm) MAX. SUPPORTED JOIST LENGTH
-MIN. 2200psi (15MPa) CONCRETE AFTER 28 DAYS
-SHALL REST ON UNDISTURBED SOIL, ROCK OR COMPACTED GRANULAR FILL W/ MIN. 10,9psi (75kPa) BEARING CAPACITY
-FTG. TO HAVE CONTINUOUS KEY
-FTG. SIZES MAY BE REDUCED FOR SOILS W/ GREATER BEARING CAPACITY (AS PER SOILS ENGINEERING REPORT)

TYPICAL STRIP FOOTING: (EXTERNAL WALLS)

O.B.C. 9.15.3.5.

-FTG. TO EXTEND MIN. 4'-0" (1200mm) BELOW GRADE
BRICK VENEER
-1 STOREY - 13" X 4" (330mm X 100mm)
-2 STOREY - 19" X 6" (485mm X 155mm)
-3 STOREY - 26" X 9" (660mm X 230mm)

SIDING:

-1 STOREY - 10" X 4" (255mm X 100mm)
-2 STOREY - 14" X 4" (340mm X 100mm)
-3 STOREY - 18" X 5" (460mm X 130mm)

TYPICAL STRIP FOOTING: (INTERIOR BEARING WALLS)

O.B.C. 9.15.3.6.

-1 STOREY MASONRY - 16" X 4" (410mm X 100mm)
-12" X 4" (305mm X 100mm)
-2 STOREY MASONRY - 26" X 9" (650mm X 230mm)
-18" X 5" (450mm X 130mm)
-3 STOREY MASONRY - 36" X 14" (900mm X 360mm)
-3 STOREY STUD - 24" X 8" (600mm X 200mm)

STEP FOOTING:

O.B.C. 9.15.3.9.

-23 5/8" (600mm) MAX. VERTICAL RISE & 23 5/8" (600mm) MIN. HORIZONTAL RUN.

DRAINAGE TILE OR PIPE:

O.B.C. 9.14.3.

-4" (100mm) MIN. DIA. L&D ON UNDISTURBED OR WEL COMPACTED SOIL W/ TOP OF TILE OR PIPE TO BE BELOW BOTTOM OF F.L.R. SLAB
-COVER TOP & SIDES OF TILE OR PIPE W/ 5/7/8" (150mm) OF CRUSHED STONE OR OTHER COARSE CLEAN GRANULAR MATERIAL
-TILE SHALL DRAIN TO A SEWER, DRAINAGE DITCH, OR DRY WELL.

BASEMENT SLAB:

O.B.C. 9.13. & 9.14.

-3" (75mm) CONCRETE SLAB
-2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.14.4.5.
-DAMP-PROOF BELOW SLAB W/ MIN. 0.006" (0.15mm) POLYETHYLENE OR TYPE 'S' ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS.
-DAMP-PROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi (25MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS
-4" (100mm) OF COURSE GRANULAR MATERIAL
-PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG.
-WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO O.B.C. 9.13.3.
-FLOOR DRAIN PER O.B.C. 9.31.4.4.
-R10 (RS1 1.76) INSULATION AT PERIMETER OF SLAB WHERE GRADE IS WITHIN 23-1/2" (600mm) OF BASEMENT SLAB EDGE. INSULATION TO EXTEND TO NOT LESS THAN 23-1/2" (600mm) BELOW EXTERIOR GRADE LEVEL (O.B.C. 38-12-2.1.1.6 (5))
-UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFIRM TO SUPPLEMENTARY STANDARD (O.B.C. 38-9)

SLAB ON GROUND:

O.B.C. 9.13.3.

-3" (75mm) CONCRETE SLAB - O.B.C. 9.14.4.3.
-2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.14.4.5.
-DAMP-PROOF BELOW SLAB W/ MIN. 0.006" (0.15mm) POLYETHYLENE OR TYPE 'S' ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS.
-DAMP-PROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi (25MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS
-R10 (RS1 1.76) INSULATION UNDER ENTIRE SLAB WHERE THE ENTIRE SLAB IS WITHIN 23-1/2" (600mm) OF GRADE.
-4" (100mm) OF COURSE GRANULAR MATERIAL
-PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG.
-WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO O.B.C. 9.13.3.
-FLOOR DRAIN PER O.B.C. 9.31.4.4.
-UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFIRM TO SUPPLEMENTARY STANDARD (O.B.C. 38-9)

GARAGE SLAB / EXTERIOR SLAB:

-4" (100mm) CONCRETE SLAB

-UNREINFORCED CONCRETE
-4650psi (32MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS FOR UNREINFORCED CONC. & W/ 5.8% AIR ENTRAINMENT - O.B.C. 9.3.1.4.
-6" X 6" (W23 X W 23) WIRE MESH LOCATED NEAR MID-DEPTH OF SLAB
-4" (100mm) OF COURSE GRANULAR MATERIAL
-ANY FILL PLACED UNDER SLAB, OTHER THAN COURSE CLEAN GRANULAR MATERIAL, SHALL BE COMPACTED.

PLASTER:

O.B.C. 9.15.5.3.

-CONCRETE NIB - 4" X 12" (100mm X 300mm)
-BLOCK NIB - 4" X 12" (100mm X 300mm) BONDED & TIED TO WALL AS PER O.B.C. 9.20.11.2. TOP 7/7/8" (200mm) SOLID.
OR
-BEAM POCKET
-4" (100mm) INTO FIN. WALL W/ WIDTH TO MATCH BEAM SIZE.
-1/2" (13mm) SPACE AROUND WOOD BEAMS (O.B.C. 9.23.2.2)

STRUCTURAL COLUMNS:

-SIZES BASED ON COLUMN SUPPORTING BEAMS CARRYING LOADS FROM NOT MORE THAN 2 WOOD FRAME FLOORS, WHERE THE LENGTHS OF JOISTS CARRIED BY SUCH BEAMS DO NOT EXCEED 16'-1" (4.9m) AND THE LIVE LOAD ON ANY FLOOR DOES NOT EXCEED 50psf (2.4Kpa).

STEEL PIPE COLUMN:

O.B.C. 9.15.3.4. & 9.17.3.

-FIXED COLUMN
-MIN. 3 1/2" (90mm) DIA. W/ 3/16" (4.76mm) WALL THICKNESS
-FOR STEEL BEAMS, CLIPS @ TOP & MIN. 6" X 4" X 1/4" (152mm X 100mm X 6.35mm) STEEL BTM. PLATE
-FOR WOOD BEAMS, MIN. 4"x4"x1/4" (100mm X 100mm X 6.35mm) STEEL TOP & BTM. PLATES, OR TOP PLATE TO EXTEND MIN. WIDTH OF BEAM
-ADJUSTABLE COLUMNS TO CONFORM TO CAN/CSG-2.2M WHERE IMPOSED LOAD DOES NOT EXCEED 36 kN (O.B.C. 9.17.3.4)

COL. SPACING:

2 STOREY

-MAX. 9'-10" (2997mm)
-34" X 34" X 1/2"

3 STOREY

-MAX. 16'-0" (4880mm)
-44" X 44" X 2 1/2"

4 STOREY

-MAX. 9'-10" (2997mm)
-44" X 44" X 2 1/2"

5 STOREY

-MAX. 16'-0" (4880mm)
-44" X 44" X 2 1/2"

6 STOREY

-MAX. 16'-0" (4880mm)
-44" X 44" X 2 1/2"

7 STOREY

-MAX. 16'-0" (4880mm)
-44" X 44" X 2 1/2"

8 STOREY

-MAX. 16'-0" (4880mm)
-44" X 44" X 2 1/2"

9 STOREY

-MAX. 16'-0" (4880mm)
-44" X 44" X 2 1/2"

10 STOREY

-MAX. 16'-0" (4880mm)
-44" X 44" X 2 1/2"

11 STOREY

12 STOREY

13 STOREY

14 STOREY

15 STOREY

16 STOREY

17 STOREY

18 STOREY

19 STOREY

20 STOREY

21 STOREY

22 STOREY

23 STOREY

24 STOREY

25 STOREY

26 STOREY

27 STOREY

28 STOREY

29 STOREY

30 STOREY

WOOD COLUMN:

O.B.C. 9.17.4.1.

-5 1/2" X 5 1/2" (140mm X 140mm) SOLID WOOD COLUMN.
-METAL SHOE ANCHORED TO FOOTING
-25" X 25" X 12" (640mm X 640mm X 300mm) CONC. PAD (1 FLOOR SUPPORTED W/ 9'-10" COL. SPACING)
-34" X 34" X 14" (864mm X 864mm X 360mm) CONC. PAD (2 FLOORS SUPPORTED W/ 9'-10" COL. SPACING)

BLOCK PARTY WALL BEAM END BEARING: (WOOD BEAM / GIRDER TRUSSES)

-2"x8" X 12" LEDGER BOARD FASTENED W/ 2" (50mm) ANCHOR BOLTS @ 4" O.C.

-WHERE WOOD BEAMS BEAR ON FIREWALLS USE GENERAL NOTE 11 WHERE REQUIRED TO OBTAIN 6" SEPARATION DISTANCE BETWEEN ADJACENT BEAMS

BLOCK PARTY WALL BEAM END BEARING: (STEEL BEAM)

-12"x11" X 5/8" STL. PLATE ON TOP OF SOLID CONCRETE BLOCK WITH 2- 1/2" Ø 8" ANCHOR BOLTS.

FOUNDATION WALL:

O.B.C. 9.15.4.2.

-FOR WALLS NOT EXCEEDING 9'-10" (3000mm) IN LATERALLY SUPPORTED HEIGHT.
-MAX. UNSUPPORTED HEIGHT OF 3'-11" (1200mm) & MAX. SUPPORTED HEIGHT OF 7'-0" (2150mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR.
-FOR WALLS NOT EXCEEDING 9'-0" (2750mm) IN LATERALLY SUPPORTED HEIGHT.

WALL ASSEMBLIES:

O.B.C. 9.15.4.7.

-WHERE THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO ALLOW MASONRY FACING, THE MIN. REDUCED THICKNESS SHALL NOT BE LESS THAN 3-1/2" (90mm) THICK.
-TIE TO FACING MATERIAL WITH METAL TIE SPACED MAX. @ 7/7/8" (200mm) VERTICALLY O.C. & 2'-11" (600mm) HORIZONTALLY
-FILL SPACE BETWEEN WALL AND FACING SOLID W/ MORTAR
-WHERE WALL IS REDUCED FOR JOISTS, THE REDUCED THICKNESS SHALL BE MAX. 13-3/4" (350mm) HIGH & MIN. 3-1/2" (90mm) THICK
DAMP-PROOFING & WATERPROOFING:
-DAMP-PROOF THE EXTERIOR FACE OF WALL BELOW GRADE AS PER O.B.C. 9.13.2.
-WHERE INSULATION EXTENDS TO MORE THAN 4'-0" (1200mm) BELOW GRADE, A FIN. WALL DRAINAGE LAYER SHALL BE PROVIDED IN CONFORMANCE TO O.B.C. 9.14.2.1. (2) (a) (4)
-FINISHED BASEMENT SHALL HAVE INTERIOR DAMP-PROOFING EXTENDING FROM SLAB TO GRADE LEVEL & SHALL CONFORM TO O.B.C. 9.13.3.4 (3)
-WHERE HYDROSTATIC PRESSURE OCCURS, FIN. WALLS SHALL BE WATERPROOFED AS PER O.B.C. 9.13.3.
-WALLS THAT ARE WATERPROOFED DO NOT REQUIRE DAMP-PROOFING.

REDUCTION OF THICKNESS:

O.B.C. 9.15.4.7.

-WHERE THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO ALLOW MASONRY FACING, THE MIN. REDUCED THICKNESS SHALL NOT BE LESS THAN 3-1/2" (90mm) THICK.
-TIE TO FACING MATERIAL WITH METAL TIE SPACED MAX. @ 7/7/8" (200mm) VERTICALLY O.C. & 2'-11" (600mm) HORIZONTALLY
-FILL SPACE BETWEEN WALL AND FACING SOLID W/ MORTAR
-WHERE WALL IS REDUCED FOR JOISTS, THE REDUCED THICKNESS SHALL BE MAX. 13-3/4" (350mm) HIGH & MIN. 3-1/2" (90mm) THICK
DAMP-PROOFING & WATERPROOFING:
-DAMP-PROOF THE EXTERIOR FACE OF WALL BELOW GRADE AS PER O.B.C. 9.13.2.
-WHERE INSULATION EXTENDS TO MORE THAN 4'-0" (1200mm) BELOW GRADE, A FIN. WALL DRAINAGE LAYER SHALL BE PROVIDED IN CONFORMANCE TO O.B.C. 9.14.2.1. (2) (a) (4)
-FINISHED BASEMENT SHALL HAVE INTERIOR DAMP-PROOFING EXTENDING FROM SLAB TO GRADE LEVEL & SHALL CONFORM TO O.B.C. 9.13.3.4 (3)
-WHERE HYDROSTATIC PRESSURE OCCURS, FIN. WALLS SHALL BE WATERPROOFED AS PER O.B.C. 9.13.3.
-WALLS THAT ARE WATERPROOFED DO NOT REQUIRE DAMP-PROOFING.

FOUNDATION WALLS @ UNSUPPORTED OPENINGS:

-2-20M BARS IN TOP PORTION OF WALL (UP TO 8'-0" OPENING)

-3-20M BARS IN TOP PORTION OF WALL (8'-0" TO 10'-0" OPENING)

-4-20M BARS IN TOP PORTION OF WALL (10'-0" TO 15'-0" OPENING)

-BARS STACKED VERTICALLY AT INTERIOR FACE OF WALL.

-BARS TO HAVE MIN. 2" (50mm) CONCRETE COVER

-BARS TO EXTEND 2'-0" (600mm) BEYOND BOTH SIDES OF OPENING.

FRAME WALL CONSTRUCTION:

O.B.C. 9.23.

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7/7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.1)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.1.6.
-2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C.
-MIN. R22 (RS1 3.87) INSULATION (ZONE 1, O.B.C. 12.1.1.2.A)
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3 & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE: -SUPPORT FOR 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

O.B.C. 38-3. WALL = EW1b (STC = N/A, FIRE = 45 MIN)

FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE THE FOLLOWING MATERIALS:

-REPLACE R22 (RS1 3.87) INSULATION WITH R22 (RS1 3.87) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 4.8 kg/sq.m.
-REPLACE 1/2" (12.7mm) INTERIOR GYPSUM BOARD WITH 1/2" (12.7mm) TYPE 'X' GYPSUM BOARD.

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE):

REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:

-NON-COMBUSTIBLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).
OR
-MIN. SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING WHICH REPLACES EXTERIOR PLYWOOD OR EQUIV.

ALTERNATE FRAME WALL CONSTRUCTION:

O.B.C. 9.23.

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7/7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.1)
-1 1/2" (38mm) R8 (RS1 1.41) RIGID INSULATION W/ TAPED JOINTS (O.B.C. 9.27.3.4)
-864CS W/ CONT. 16 GAUGE STEEL T BRACES FROM TOP PLATE TO BTM. PLATE FOR THE FULL LENGTH OF WALL, OR CONT. 2" X 4" (38mm X 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO BTM. PLATE FOR FULL LENGTH OF WALL.
-2" X 4" (38mm X 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C. ON BOTTOM FLR. WHEN 3 STOREYS.
-R14 (RS1 2.46) INSULATION (ZONE 1, O.B.C. 12.1.1.2.A)
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3 & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE: -SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

O.B.C. 38-3. WALL = EW1b (STC = N/A, FIRE = 45 MIN)

FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:

-ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.1.6. BETWEEN RIGID INSULATION AND WOOD STUD.
-REPLACE R14 (RS1 2.46) INSULATION WITH R14 (RS1 2.46) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 2.8 kg/sq.m.
-REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE):

O.B.C. 38-3. WALL = EW1b (STC = N/A, FIRE = 45 MIN)

FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:

-ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.1.6. BETWEEN RIGID INSULATION AND WOOD STUD.
-REPLACE R14 (RS1 2.46) INSULATION WITH R14 (RS1 2.46) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 2.8 kg/sq.m.
-REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:

-NON-COMBUSTIBLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).
OR
-MIN. SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING PAPER OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING ON EXTERIOR SIDE OF RIGID INSULATION

FRAME WALL CONSTRUCTION @ GARAGE:

O.B.C. 9.23.

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7/7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.1)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.1.6.
-2" X 4" (38mm X 89mm) WOOD STUDS @ 16" (400mm) O.C.
-1/2" (12.7mm) GYPSUM BOARD
NOTE: -SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

O.B.C. 38-3. WALL = EW1b (STC = N/A, FIRE = 45 MIN)

FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-ADD ABSORPTIVE MATERIAL WITH A MASS OF AT LEAST 2.8 kg/sq.m.
-REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.
REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE):
REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
-NON-COMBUSTIBLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).
OR
-MIN. SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING PAPER OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING WHICH REPLACES EXTERIOR PLYWOOD OR EQUIV.

BRICK VENEER CONSTRUCTION:

O.B.C. 9.23.

-3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36-1" (11mm) MAX. HEIGHT
-MIN. 0.003" (0.076mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL SPACING
-PROVIDE WEEP HOLES @ 2'-7" (800mm) O.C. @ BTM. COURSE & OVER OPENINGS
-BASE FLASHING UP TO 5 7/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.12)
-BRICK OR STONE SITS UNDER OPENINGS, FLASHING UNDER
-1" (25mm) AIR SPACE
-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.1.6.
-2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C.
-MIN. R22 (RS1 3.87) INSULATION (ZONE 1, O.B.C. 12.1.1.2.A)
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3 & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE: -SUPPORT FOR 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

O.B.C. 38-3. WALL = EW1b (STC = N/A, FIRE = 45 MIN)

FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-REPLACE R22 (RS1 3.87) INSULATION WITH R22 (RS1 3.87) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 4.8 kg/sq.m.
-REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

ALTERNATE BRICK VENEER CONSTRUCTION:

O.B.C. 9.23.

-3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36-1" (11mm) MAX. HEIGHT
-MIN. 0.003" (0.076mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL SPACING
-PROVIDE WEEP HOLES @ 2'-7" (800mm) O.C. @ BTM. COURSE & OVER OPENINGS
-BASE FLASHING UP TO 5 7/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.12)
-BRICK OR STONE SITS UNDER OPENINGS, FLASHING UNDER
-1" (25mm) AIR SPACE
-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.1.6.
-2" X 4" (38mm X 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C. ON BOTTOM FLR. WHEN 3 STOREYS
-BRACE W/ CONT. 16 GAUGE STEEL T BRACES FROM TOP PLATE TO BTM. PLATE FOR THE FULL LENGTH OF WALL, OR
-CONT. 2" X 4" (38mm X 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO BTM. PLATE FOR FULL LENGTH OF WALL
-R14 (RS1 2.46) INSULATION
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3 & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE: -SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLO

17 INTERIOR STUD WALLS:

O.B.C. 1.9.23.10.1.
-2" X 4" (38mm x 89mm) WOOD STUDS @ 16" (400mm) O.C. OR
-2" X 6" (38mm x 140mm) WOOD STUDS @ 16" (400mm) O.C. W/
-DOUBLE 2" X 4" OR 2" X 6" TOP PLATES AND SINGLE BOTTOM PLATE
-1/2" (12.7mm) GYPSUM BOARD BOTH SIDES.

18 BEARING STUD WALL (BASEMENT):

-2" X 4" (38mm x 89mm) WOOD STUDS @ 16" (400mm) O.C. OR
-2" X 6" (38mm x 140mm) WOOD STUDS @ 16" (400mm) O.C. W/
-DBL. 2" X 4" OR 2" X 6" TOP PLATE.
-2" X 4" OR 2" X 6" BOTTOM PLATE ON DAMPPROOFING MATERIAL.
-1/2" (12.7mm) GYPSUM BOARD BOTH SIDES.
-1/2" (12.7mm) DIA. ANCHOR BOLTS @ 2'-10" (2400mm) O.C.
-FOOTING AS PER GENERAL NOTE #2 W/ 4" CONC. CURB

19 PARTY WALL - BLOCK:

O.B.C. 5B-3 WALL = B46 (STC = 57, FIRE = 2 HR)
-MIN. 1HR. FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF FOOTINGS
TO THE U/S OF ROOF DECK
-SPRACE BETWEEN TOP OF WALL & ROOF DECK SHALL BE TIGHTLY FILLED W/
MINERAL WOOL OR NONCOMBUSTIBLE MATERIAL & CALKED TO PREVENT
SMOKE PASSAGE
-1/2" (12.7mm) GYPSUM BOARD W/ TAPED JOINTS BOTH SIDES
-2" X 2" (38mm x 38mm) WOOD STRAPPING @ 24" (600mm) O.C. BOTH
SIDES
-ABSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF 90% OF THE
CAVITY.

19b PARTY WALL - BLOCK (AGAINST GARAGE):

O.B.C. 5B-3 WALL = B5C (STC = 51, FIRE = 2 HR)
-MIN. 1HR. FIRE-RESISTANCE RATING CONTINUOUS
-1/2" (12.7mm) GYPSUM BOARD
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.
& 9.25.4.
-2" X 4" (38mm x 89mm) WOOD STRAPPING @ 16" (400mm) O.C.
-R20 (R3 3.52) RIGID INSULATION
-1/2" (12.7mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE)
-1/2" (12.7mm) GYPSUM BOARD @ WALL & U/S OF CEILING BETWEEN
HOUSE AND GARAGE
-TAPE AND SEAL ALL JOINTS GAS TIGHT
REQ. INSULATION VALUES:

INSULATION VALUES PROVIDED BY CAN/CSA-F280-M90	
-RIGID INSULATION	= 20.00
-LOW DENSITY CONCRETE BLOCK	= 1.70
-WOOD FRAME W/ GYPSUM	= 2.72
-AIR FILM - MOVING	= 0.69
-AIR FILM - STILL	= 0.17
TOTAL "R" VALUE	= 25.27

19b FIREWALL:

O.B.C. 9.10.11.1. & 3.1.10. & 5B-3 WALL = B46 (STC = 57, FIRE = 2 HR)
-ONE FIREWALL IS REQUIRED FOR EVERY 6460 S.F. (600 SQ.M) OF BUILDING
AREA. O.B.C. 1.3.2.2.47.
-1/2" (12.7mm) GYPSUM BOARD W/ TAPED JOINTS
-2" X 2" (38mm x 38mm) WOOD STRAPPING @ 24" (600mm) O.C. ON BOTH SIDES
OF WALL
-SOUND ABSORPTIVE MATERIAL EACH SIDE FILLING 90% OF THE CAVITY
-1/2" (12.7mm) CONC. BLOCK. MIN. 2 HR. FIRE-RESISTANT RATING
-EVERY FIREWALL SHALL BE CONTINUOUS THROUGH ALL BUILDING STOREYS
-STAGGER JOISTS & BEAMS MIN. 3 1/2" (90mm) @ FIRE WALLS AS PER
O.B.C. 9.10.9.9 (1) & TABLE 2.1.1. 5B-2
-ACOUSITCAL SEALANT AS PER O.B.C. 5B-3 (NOTE (2) TO TABLE 1)
-PROVIDE FAST FASCIA @ EAVES W/ BARICK CORRELATING
-EXTEND 5 7/8" (150mm) ABOVE ROOF SURFACES & HAVE ALUMINUM CAP W/
THROUGH WALL FLASHING PER O.B.C. 3.1.10.4 (1)
-WHERE THE DIFFERENCE IN HEIGHT BETWEEN ADJACENT ROOFS IS GREATER
THAN 9'10" (3m), WALL NEED NOT EXTEND FAST UPPER ROOF SURFACE PER
O.B.C. 3.1.10.4 (2)

20 PARTY WALL - FOUNDATION:

O.B.C. 9.15.4.2.
-7 7/8" (200mm) SOLID CONC. FOUNDATION WALL @ 2200psf (1 5MPa)
COMPRESSIVE STRENGTH AFTER 28 DAYS
-FOUNDATION WALL TO REST ON FOOTING PER GENERAL NOTE #2

21 PARTY WALL - WOOD STUD:

O.B.C. 5B-3 WALL = W13d (STC = 57, FIRE = 1 HR)
-MIN. 1HR. FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF
FOOTINGS TO THE U/S OF ROOF DECK
-2 ROWS 2"x4"(38mm x 89mm) STUDS @ 16"(400mm) O.C. W/ SEPARATE
2" X 4" (38mm x 89mm) BOTTOM PLATE & SEPARATE DOUBLE 2" X 4"
(38mm x 89mm) TOP PLATES
-SOUND ABSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF
90% OF THE CAVITY.
-5/8" (16mm) TYPE 'X' GYPSUM BOARD BOTH SIDES W/ JOINTS TAPED &
FILLED.

22 GARAGE WALL & CEILING:

O.B.C. 9.10.9.16.13
-1/2" (12.7mm) GYPSUM BOARD ON BOTH SIDES OF WALL & U/S OF CEILING
BETWEEN HOUSE AND GARAGE
-TAPE AND SEAL ALL JOINTS GAS TIGHT
-R20 (R3 3.87) INSULATION IN WALLS.
-R21 (R3 5.41) INSULATION IN CEILINGS W/ FIRE STOP
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4. FOR FLOOR ABOVE.
-INSULATION AROUND DUCTS AND PIPING NOT TO EXCEED 4".
-INSULATED GARAGE AREA (REFER TO MECHANICAL STANDARDS)
-1/2" (12.7mm) GYPSUM BOARD
-ROOF FRAMING MEMBERS ARE FASTENED TO TOP PLATE
-4-3 1/4" (82mm) TOE NAILS
-BOTTOM PLATES ARE FASTENED TO FLOOR JOISTS BLOCKED
-RIM JOIST WITH 3 1/4" (82mm) NAILS AT 7 1/2" (200mm) O.C.

22b WALLS ADJACENT TO ATTIC SPACE:

-1/2" (12.7mm) GYPSUM BOARD
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-2" X 6" (38mm x 140mm) WOOD STUDS @ 16" (400mm) O.C.
-R22 (R3 3.87) INSULATION
-1/2" (12.7mm) GYPSUM BOARD OR 1/4" (6mm) PLYWOOD SHEATHING
ON ATTIC SIDE
-ATTIC ACCESS TO BE PROVIDED AS PER O.B.C. 9.19.2.1.

23 DOUBLE VOLUME WALLS:

O.B.C. 9.23.10.1.
-3/8" (9.5mm) PLYWOOD, OSB OR WATERBOARD SHEATHING
-REFER TO PLAN FOR STUD SPECIFICATION
-STUDS FASTENED AT TOP & BOTTOM WITH 3/4-1 1/4" (82mm) TOE NAILS
-DOUBLE TOP PLATES FASTENED TOGETHER WITH 3" (76mm) AT
7 7/8" (200mm) O.C.
-SOLID BRIDGING AT 3'-1 1/2" (1200mm) O.C.
-MIN. R22 (R3 3.87) INSULATION (ZONE 1, O.B.C. 12.1.1.2.A)
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE WITH O.B.C.
9.25.3. & 9.25.9.

24 EXPOSED FLOOR:

-FLOOR AS PER NOTE # 28
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/
O.B.C. 9.25.3. & 9.25.4.
-R31 (R3 5.46) INSULATION
-VENTED ALUMINUM SOFFIT

24b SUNKEN BEARING AREAS:

-USE SOLID BUILD-UP WOOD BEARING POST TO SUPPORT SUNKEN AREA
AT FOUNDATION WALLS. EXTEND FOOTINGS TO SUPPORT POSTS.
-WHERE GRADING CONDITIONS WILL ALLOW, CHECK FOUNDATION
WALLS INSTEAD OF USING BEARING POSTS.
-FLOOR STRUCTURE AS PER NOTE # 28.

25 DOUBLE MASONRY WYTHE WALL:

O.B.C. 9.20.8.2
-3-1/2" MASONRY VENEER ON 2" MORTAR JOINT ON 3 1/2" MASONRY VENEER
-WYTHES TO BE TIED W/ METAL TIES INSTALLED AS PER O.B.C. 9.20.9.4.
-SILL PLATE REQUIRED FOR ROOF AND CEILING FRAMING MEMBERS
-6" SILL W/ 2" BEARING ON EACH SIDE & ANCHOR BOLTS @ 4'-0" O.C.
NOTE: MASONRY TO BE SOLID & MORTAR JOINT FILLED SOLID FOR FLOOR
JOISTS BEARING ON WYTHES. FLOOR JOISTS ARE NOT TO PROJECT INTO CAVITY
AREA.

25b CORBEL MASONRY VENEER:

-MASONRY VENEER TO BE CORBELLED AS PER O.B.C. 9.20.12.3.(1)
FLOOR ASSEMBLIES:

26 SILL PLATE:

O.B.C. 9.23.7.
-2" X 4" (38mm x 89mm) PLATE
-1/2" (12.7mm) DIA. ANCHOR BOLTS @ 7'-10" (2400mm) O.C. FASTENED TO
PLATE W/ NUTS AND WASHERS & SHALL BE EMBEDDED NOT LESS THAN 4"
(100mm) INTO FOUNDATION WALL
-SILL PLATE TO BE CALKED, OR PLACED ON A LAYER NOT LESS THAN 1"
(25mm) THICK BEFORE COMPRESSIONING, OR FOAM GASKET, OR PLACED
ON FULL BED OF MORTAR.

27 BRIDGING & STRAPPING:

O.B.C. 9.23.9.4.
a) STRAPPING
-1" X 3" (19mm x 44mm) NAILED TO U/S OF JOISTS @ MAX. 6'-1 1/2" (2100mm) O.C.
-FASTENED TO SILL OR HEADER @ ENDS
b) BRIDGING
-1" X 3" (19mm x 44mm) OR 2" X 2" (38mm x 38mm) CROSS BRIDGING @ MAX.
6'-1 1/2" (2100mm) O.C.
c) BRIDGING & STRAPPING
-a) & b) USED TOGETHER OR
-1-1/2" (38mm) SOLID BLOCKING @ MAX. 6'-1 1/2" (2100mm) O.C. USED WITH
STRAPPING (a)
d) FLOORING OR PANEL TYPE CEILING
-STRAPPING NOT REQUIRED IF FLOORING STRIPS OR PANEL TYPE CEILING FINISH
IS ATTACHED DIRECTLY TO JOISTS.

28 FLOOR ASSEMBLY:

O.B.C. 9.23.14.3. & 9.23.14.4
-5/8" (15.9mm) WATERBOARD (R-1 GRADE) OR EQUIVALENT
-FLOOR JOISTS AS PER FLOOR PLANS

29 PORCH SLABS ABOVE COLD CELLAR:

O.B.C. 9.39.1.4.
-REINFORCED CONCRETE SLABS ABOVE COLD CELLARS THAT ARE SUPPORTED
ON FOUNDATION WALLS NOT TO EXCEED 8'-2"
-4-7/8" (125mm) 4650 PSI (32 MPa) CONC. SLAB WITH 5 TO 8% AIR ENTRAINMENT
-REINFORCE WITH 10M BARS @ 7 7/8" (200mm) EACH WAY
-1-1/4" (30mm) CLEAR COVER FROM THE BOTTOM OF THE SLAB
-3" (75mm) END BEARING ON FOUNDATION WALL
-23 5/8" (600mm) X 23 5/8" (600mm) 10M DOWELS @ 23 5/8" (600mm) O.C.

30 EXTERIOR BALCONY ASSEMBLY:

-1-1/4" X 3 1/2" (32mm x 91mm) PRESSURE TREATED DECKING W/ 1/4" SPACING
-2"x4" WOOD PURLINS (CUT DIAGONALLY) @ 12" O.C. LAYING UNFASTENED
ON SINGLE PLY WATERPROOF ROOF MEMBRANE OR EQUIVALENT ON 5/8"
(15.9mm) EXTERIOR GRADE PLYWOOD SHEATHING OR 2"x4" WOOD PURLINS
(CUT DIAGONALLY) @ 12" O.C. DIRECTLY ON 2"x8" ROOF JOISTS @ 12" O.C.
(OR AS NOTED ON PLAN)
-EXTERIOR GUARD AS PER #36a
-SLOPE ASSEMBLY MINIMUM 2% TO ROOF SCUPPER
-REQUIRED FOR OVER HEATED SPACES:
-ADD 2"x2" (38mm x 38mm) CROSS PURLINS @ 16" (400mm) O.C. FOR
VENTILATION OVER JOISTS (OBC 9.19.1.2. VENTING NOT LESS THAN 1/150 OF
CEILING AREA)
-ADD R31 (R3 5.46) INSULATION BETWEEN JOISTS
-ADD CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.
& 9.25.4.
-ADD 1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR
-ADD 5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. 19.29.5.3.)

30b EXTERIOR FLAT ROOF ASSEMBLY:

-SINGLE PLY WATERPROOF ROOF MEMBRANE OR EQUIVALENT
-INSTALLED PER MANUFACTURER'S SPECIFICATIONS.
-1/4" EXTERIOR GRADE WOOD PANEL TYPE UNDERLAY TAPEDED PURLINS
SLOPED MIN. 2% TO ROOF SCUPPER.
-3/8" EXTERIOR GRADE PLYWOOD SHEATHING ON
-2"x8" ROOF JOISTS @ 12" O.C. (OR AS NOTED ON PLAN)
-REQUIRED FOR OVER HEATED SPACES:
-ADD 2"x2" (38mm x 38mm) CROSS PURLINS @ 16" (400mm) O.C. FOR
VENTILATION OVER JOISTS (OBC 9.19.1.2. VENTING NOT LESS THAN 1/150 OF
CEILING AREA)
-ADD R31 (R3 5.46) INSULATION BETWEEN JOISTS
-ADD CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.
& 9.25.4.
-ADD 1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR
-ADD 5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. 19.29.5.3.)

31 ROOF ASSEMBLIES

31a TYPICAL ROOF:

O.B.C. 9.26.
-NO. 210 (30. SKG/m2) ASPHALT SHINGLES
-FOR ROOFS BETWEEN 4'-12" & 8'-12" PROVIDE EAVES PROTECTION TO
EXTEND UP THE ROOF SLOPE MIN. 2'-1 1/2" (900mm) FROM EDGE TO A LINE NOT
LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTERIOR WALL.
-EAVES PROTECTION Laid BENEATH STARTER STRIP.
-EAVE PROTECTION NOT REQUIRED OVER UNHEATED SPACES.
-STARTER STRIP AS PER O.B.C. 9.26.7.2.
-STARTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.(3)
-3/8" (10mm) PLYWOOD SHEATHING OR OSB (0-2 GRADE) WITH 1" CLIPS
APPROVED WOOD TRUSSES @ 24" (600mm) O.C. (REFER TO MANUFACTURERS
LAYOUT)
-TRUSS BRACING AS PER TRUSS MANUFACTURER
-EAVES/ROUGH ON PREFINISHED FASCIA AND VENTED SOFFIT (VINYL OR
ALUMINUM)
-ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH 50% AT SOFFIT.

32 CEILING:

-R20 (R3 3.87) INSULATION
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.
& 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR
-5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. 19.29.5.3.)

32b VALUED OR CATHEDRAL CEILING:

O.B.C. 9.26. & TABLE 4-4
-NO. 210 (30. SKG/m2) ASPHALT SHINGLES
-FOR ROOFS BETWEEN 4'-12" & 8'-12" PROVIDE EAVES PROTECTION TO
EXTEND UP THE ROOF SLOPE MIN. 2'-1 1/2" (900mm) FROM EDGE TO A LINE NOT
LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTERIOR WALL.
-EAVE PROTECTION Laid BENEATH STARTER STRIP.
-EAVE PROTECTION NOT REQUIRED OVER UNHEATED SPACES OR WHERE
STARTER STRIP ARE 8'-12" OR GREATER PER O.B.C. 9.26.5.1.
-STARTER STRIP AS PER O.B.C. 9.26.7.2.
-STARTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.(3)
-3/8" (10mm) PLYWOOD SHEATHING OR OSB (0-2 GRADE) WITH 1" CLIPS.
-2"x8" (38mm x 140mm) @ 16" O.C. W/ 2"x2" (38mm x 38mm) CROSS PURLINS
@ 24" O.C. MAX. SPAN 13'-3" (4050mm) OR
-2"x10" (38mm x 235mm) @ 16" O.C. W/ 2"x2" (38mm x 38mm) CROSS
PURLINS @ 24" O.C. MAX. SPAN 17'-9" (5180mm)

33 CONVENTIONAL FRAMING:

O.B.C. TABLE A6 OR A7
-2" X 6" (38mm x 140mm) RAFTERS @ 16" (400mm) O.C. MAX. SPAN 12'-9"
(3900mm)
-2"x4" (38mm x 89mm) COLLAR TIES AT MIDSPANS
-CEILING JOISTS TO BE 2" X 6" (38mm x 140mm) @ 16" (400mm) O.C.
UNLESS OTHERWISE NOTED.
-HIP & VALLEY RAFTERS TO BE MIN. 2" (50mm) LARGER THAN COMMON
RAFTERS & MIN. 1 1/2" (38mm) THICK.

34 ATTIC ACCESS HATCH:

O.B.C. 9.19.2.1.
-19 3/4" X 22 1/2" (500mm X 700mm) ATTIC HATCH WITH
WEATHERSTRIPPING & BACKED W/ R20 (R3 3.52) INSULATION.

35 GENERAL:

35a PRIVATE STAIRS:

O.B.C. 9.8.4.
-MAX. RISE = 7-7/8" (200mm)
-MIN. RUN = 8-1/4" (210mm)
-MIN. TREAD = 9-1/4" (235mm)
-MAX. NOSING = 1" (25mm)
-MIN. HEADROOM = 6'-5" (1950mm)
-MIN. WIDTH = 2'-10" (640mm)
-MIN. WIDTH (BETWEEN WALL FACES) = 2'-11" (690mm)
-EXIT STAIRS, BETWEEN GUARDS)
-ANGLED TREADS: = 5 7/8" (150mm)
-MIN. RUN = 7 7/8" (200mm)
-FINISHED RAILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS
-EXTERIOR CONC. STEPS TO HAVE MIN. 9 1/4" (235mm) TREAD &
MAX. 7 7/8" (200mm) RISE
-FOUND. WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2
-FIG. FOR FOUND. WALL TO BE MIN. 4'-0" (1220mm) BELOW GRADE
HANDRAILS:
O.B.C. 9.8.7
-ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm)
-TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3'-7" (1100mm)
-ONE HANDRAIL IS REQUIRED ON CURVED STAIRS OF ANY WIDTH WITHIN
DWELLING UNITS
-HANDRAILS ARE TO BE CONTINUOUS EXCEPT WHERE INTERRUPTED BY DOOR
WAYS, LANDINGS OR POSTS AT CHANGES IN DIRECTION

35b PUBLIC STAIRS:

O.B.C. 9.8.4.
-MAX. RISE = 7-3/8" (180mm)
-MIN. RUN = 11" (280mm)
-MIN. TREAD = 11" (280mm)
-MAX. NOSING = 1" (25mm)
-MIN. HEADROOM = 6'-9" (2050mm)
-MIN. WIDTH = 2'-11" (690mm)
-EXIT STAIRS, BETWEEN GUARDS)
-FINISHED RAILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS
-FOUND. WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2
-FIG. FOR FOUND. WALL TO BE MIN. 4'-0" (1220mm) BELOW GRADE
HANDRAILS:
O.B.C. 9.8.7
-ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm)
-TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3'-7" (1100mm)
-HANDRAILS ARE TO BE CONTINUOUS INCLUDING STEP
STRINGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED
WIDTH OF THE STAIR

35c PROJECTIONS:

O.B.C. 9.8.7.4
-2'-10" (655mm) MIN. TO 3'-2" (965mm) MAX.
-3'-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS
-MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A
STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING
HEIGHT:
O.B.C. 9.8.7.4
-2'-10" (655mm) MIN. TO 3'-2" (965mm) MAX.
-3'-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS
-MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A
STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING
PROJECTIONS:
O.B.C. 9.8.7.6
-HANDRAILS AND PROJECTIONS BELOW HANDRAILS INCLUDING STEP
STRINGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED
WIDTH OF THE STAIR
TERMINATION:
O.B.C. 9.8.7.3
-ONE HAND RAIL SHALL EXTEND HORIZONTALLY NOT LESS THAN 11 3/4"
(300mm) BEYOND THE TOP & BOTTOM OF EACH STAIR AS
FINISH:
O.B.C. 9.8.9.6
-TREADS ARE TO BE WEAR AND SLIP RESISTANT, SMOOTH, EVEN AND FREE
FROM DEFECTS PER OBC 9.8.9.6.4 (A)
-STAIRS AND RAMPS SHALL HAVE A COLOUR CONTRAST OR DISTINCTIVE
VISUAL PATTERN TO DEMARK THE LEADING EDGE OF THE TREADS,
LANDING AND THE BEGINNING AND END OF A RAMP.

36 INTERIOR GUARDS:

O.B.C. 5B-7.8. & 9.8.8.3.
-GUARDS TO BE 3'-6" (1070mm) HIGH
-FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2'-11" (900mm) HIGH
-INCLUDES WINDOWS COVER STAIRS, RAMPS AND LANDINGS
-PICKETS TO HAVE 4" (100mm) MAX. SPACING
-GUARDS FOR FLIGHTS OF STEPS (EXCEPT EXIT STAIRS) TO BE 2'-11" (900mm) HIGH
EXTERIOR GUARDS:
O.B.C. 5B-7.8. & 9.8.8.3.
-GUARDS ARE REQUIRED WHEN WALKING SURFACE TO GRADE IS GREATER THAN
23 5/8" (600mm).
-GUARDS TO BE 3'-6" (1070mm)
-FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2'-11" (900mm) HIGH
-FOR DWELLING UNITS GUARDS TO BE 3'-6" (1070mm) HIGH WHERE WALKING
SURFACE IS MORE THAN 5'-11" (1800mm) ABOVE ADJACENT GRADE.
-PICKETS TO HAVE 4" (100mm) MAX. SPACING
-PROVIDE MID-SPAN POSTS AS PER 5B-7.
-GUARDS FOR FLIGHTS OF STEPS (EXCEPT EXIT STAIRS) TO BE 2'-11" (900mm) HIGH
THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE
VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK.
ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD

36b EXTERIOR GUARDS:

O.B.C. 5B-7.8. & 9.8.8.3.
-GUARDS ARE REQUIRED WHEN WALKING SURFACE TO GRADE IS GREATER THAN
23 5/8" (600mm).
-GUARDS TO BE 3'-6" (1070mm)
-FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2'-11" (900mm) HIGH
-FOR DWELLING UNITS GUARDS TO BE 3'-6" (1070mm) HIGH WHERE WALKING
SURFACE IS MORE THAN 5'-11" (1800mm) ABOVE ADJACENT GRADE.
-PICKETS TO HAVE 4" (100mm) MAX. SPACING
-PROVIDE MID-SPAN POSTS AS PER 5B-7.
-GUARDS FOR FLIGHTS OF STEPS (EXCEPT EXIT STAIRS) TO BE 2'-11" (900mm) HIGH
THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE
VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK.
ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD

36b EXTERIOR GUARDS:

36b EXTERIOR GUARDS:

36b EXTERIOR GUARDS:

36b EXTERIOR GUARDS:

36b EXTERIOR GUARDS:

36b EXTERIOR GUARDS:

36b EXTERIOR GUARDS:

36b EXTERIOR GUARDS:

36b EXTERIOR GUARDS:

36b EXTERIOR GUARDS:

36b EXTERIOR GUARDS:

36b EXTERIOR GUARDS:

36b EXTERIOR GUARDS:

36b EXTERIOR GUARDS:

PROJECT NUMBER
14093

SCALE
N/A

DATE
OCT. 19/15

CHK
NC

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15


DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

DATE
OCT. 19/15

- 36b) EXTERIOR GUARDS @ JULIET BALCONY:**
-FOR RAILING SPANNING MAXIMUM OF 6'-0".
-PROVIDE PREFIN. METAL RAILING W/ 76mm VERTICAL OPENING TO CONFORM WITH O.B.C. APPENDIX A-9.8.8.5.
-GUARDS TO BE 3'-6" (1020mm)
-FOR DWELING UNITS GUARDS TO BE 2'-11" (900mm) WHERE FLOOR TO GRADE DIFFERENCE IS LESS THAN 5'-1" (1600mm) AS PER O.B.C. 9.8.8.2. OR
-FOR DWELING UNITS GUARDS TO BE 3'-6" WHERE FLOOR TO GRADE DIFFERENCE IS 5'-1" (1600mm) OR GREATER AS PER O.B.C. 9.8.8.2.
-VERTICAL END RAILING ANCHORED TO CORNER DOUBLE STUDS USING 3 ROWS OF 3/8"Ø MIN. ANCHOR BOLTS EQUALLY SPACED WITH 3" MIN. EMBEDMENT TO STUDS.
-PROVIDE SAME ANCHOR BOLTS @ 36" O.C. FOR BASE PLATE CONNECTION.
- 37) J-LINEN CLOSET 4 SHELVES MIN. 1'-2" (350mm) DEEP**
38) WASHROOMS TO BE MECHANICALLY VENTED TO PROVIDE AT LEAST ONE AIR CHANGE PER HOUR, O.B.C.-9.32.1.3.(i3)
39) -CAPPED DRYER VENT
40) 1"-x2" (19mmx38mm) BOTH SIDES OF STEEL.
41) -WOOD FRAMING MEMBERS SUPPORTED ON CONCRETE IN CONTACT WITH GROUND OR FILL SHALL BE PRESURE TREATED OR SEPARATED FROM CONCRETE W/ 6 mil POLYETHYLENE.
42) -PRECAST CONC. STEP
43) 2-RISEES MAXIMUM PERMITTED TO BE LAD ON GROUND
44) SMOKE ALARM, O.B.C.-9.10.19.
-PROVIDE 1 ON EACH FLOOR INCLUDING BASEMENTS
-PROVIDE 1 IN EACH BEDROOM
-PROVIDE 1 IN EACH HALLWAY SERVING BEDROOMS
-INSTALLED AT OR NEAR CEILING
-ALARMS TO BE CONNECTED IN CIRCUIT AND INTERCONNECTED SO ALL ALARMS WILL BE ACTIVATED IF ANY ONE OF THEM SOUNDS AND HAVE A VISUAL SIGNALING COMPONENT
-ALARMS MUST BE HARWired AND HAVE AN ALTERNATE POWER SOURCE THAT CAN POWER ALARM FOR 7 DAYS, FOLLOWED BY 4 MINUTES OF ALARM
- 45) CARBON MONOXIDE ALARM (CMA), O.B.C.-9.33.4.**
-WHERE THERE IS A FIRE, BURNING APPLIANCE A CMA SHALL BE PROVIDED ADJACENT TO EACH SLEEPING AREA.
-CMA TO BE WIRED IN CIRCUIT TO SOUND SMOKE ALARMS WHEN ACTIVATED.
- 46) -MAIN DOOR TO BE OPERABLE FROM INSIDE W/OUT KEY**
-PROVIDE A VIEWER WITH A VIEWING ANGLE OF NOT LESS THAN 160 DEG. UNLESS GLAZING IS PROVIDED IN DOOR OR A Sidelight IS PRESENT.
-R4 (RSI 0.70) WHERE A STORM DOOR IS NOT PROVIDED
- 47) -GARAGE MAIN DOORS TO BE GAS PROCEED WITH SELF CLOSER WEATHERSTRIPPING. THRESHOLD & DEAD BOLT PER O.B.C. 9.10.13.15. -R4 (RSI 0.70)**
48) -TRAVEL FROM A FLOOR LEVEL TO AN EXIT OR EGRESS DOOR SHALL BE LIMITED TO ONE FLOOR EXCEPT:
1) WHERE THAT FLOOR LEVEL HAS ACCESS TO A BALCONY OR
2) WHERE THAT FLOOR LEVEL HAS A WINDOW PROVIDING AN UNOBSTRUCTED OPENING OF NOT LESS THAN 3'-3" (1000mm) IN HEIGHT AND 21.5/8" (550mm) IN WIDTH. SUCH WINDOW SHALL BE LOCATED SO THAT THE SILL IS NOT MORE THAN 3'-3" (1000mm) ABOVE FLOOR AND 23'-0" (70mm) ABOVE ADJACENT GROUND LEVEL.
- 49) EXTERIOR COLUM W/ MASONRY PIER:**
-MIN. 6'-x6" (140mm X 140mm) WOOD POST ANCHORED TO PORCH SLAB W/ METAL SADDLE.
-TOP PORTION OF POST CLAD W/ DECOR. SURROUND PER ELEVATION DRAWINGS.
-1-4" X 1-4" MASONRY VENEER SURROUND W/ PRECAST CONCRETE CAP.
-REFER TO ELEVATION DRAWINGS FOR HEIGHT OF CAP.
-NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" POST PROVIDED THAT THEY ARE IN CONFORMANCE WITH O.B.C. 9.17.4.
- 50) EXTERIOR COLUMN:**
-MIN. 6'-x6" (140mm X 140mm) WOOD POST CLAD W/ DECOR. SURROUND (PER ELEVATION DRAWINGS) ANCHORED TO CONC. CAP W/ METAL SADDLE.
-1-4" X 1-4" MASONRY PIER TO BE CONSTRUCTED SOLID W/ PRECAST CONCRETE CAP.
-REFER TO ELEVATION DRAWINGS FOR HEIGHT OF CAP.
-NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" POST PROVIDED THAT THEY ARE IN CONFORMANCE WITH O.B.C. 9.17.4.
- 51) STUD WALL REINFORCEMENT:**
O.B.C. 9.5.2.3.
-ALL STUDS ADJACENT TO WATER CLOSERS & SHOWER BATH TUBS IN MAIN BATHROOM ARE TO BE REINFORCED TO PERMIT THE FUTURE INSTALLATION OF GRAB BARS AS PER O.B.C. 3.8.3.8.(i3) (i4) (i5) & 3.8.3.13 (i2)(i) & 3.8.3.13.(i4)(i5)
-GRAB BARS TO BE INSTALLED AS PER O.B.C. 9.8.7.7.(i2)
FRAME CONSTRUCTION:
-ALL FRAMING LUMBER TO BE NO.1 AND NO. 2 SPF UNLESS NOTED OTHERWISE.
-ROOF LOADING IS BASED ON 1.5PSF SPECIFIED COMPOSITE SNOW AND RAIN LOADS.
-JOISTS TO HAVE MIN. 1-1/2" (38mm) END BEARING
-BEAMS TO HAVE MIN. 3-1/2" (89mm) END BEARING
-DOUBLE STUDS @ OPENINGS
-DOUBLE HEADER JOISTS AROUND FLOOR OPENINGS WHEN THEY ARE BETWEEN 3'-11" (1200mm) AND TO 2'-5" (620mm)
-DOUBLE TRIMMER JOISTS WHEN HEADER JOIST LENGTH IS BETWEEN 2'-7" (800mm) AND 6'-7" (2000mm)
-DOUBLE JOISTS OR SOLID BLOCKING UNDER NON-LOAD BEARING PARALLEL PARTITIONS
-BEAMS TO BE PLACED UNDER LOADBEARING WALLS WHEN WALLS ARE PARALLEL TO FLOOR JOISTS
- ADDITIONAL COMPLIANCE ALTERNATIVES FOR PACKAGE J**
-THE MINIMUM R (RSI) VALUE FOR THERMAL INSULATION IN EXPOSED ABOVE GRADE WALLS IS PERMITTED TO BE NO LESS THAN R20 (RSI 3.52) PROVIDED: THAT THE WINDOWS AND SLIDING GLASS DOORS HAVE A MAXIMUM U-VALUE OF 1.6, OR THE THERMAL INSULATION VALUE IN BASEMENT WALLS HAS A MINIMUM R20 (RSI 3.52).
OR
-WHERE BLOWN-IN INSULATION OR SPRAY-APPLIED FOAM INSULATION IS USED, THE MINIMUM R (RSI) VALUE FOR THERMAL INSULATION IN EXPOSED ABOVE GRADE WALLS IS PERMITTED TO BE NO LESS THAN R20 (RSI 3.52) PROVIDED THAT:
a) THE THERMAL INSULATION VALUE IN A CEILING WITH AN ATTIC SPACE IS NOT LESS THAN R60 (RSI 10.59).
b) THE MINIMUM EFFICIENCY OF THE HRV IS INCREASED BY NOT LESS THAN 8 PERCENTAGE POINTS.
c) THE MINIMUM R-VALUE OF THE SPACE HEATING EQUIPMENT IS INCREASED BY NOT LESS THAN 2 PERCENTAGE POINTS.
d) THE MINIMUM EFF OF THE DOMESTIC HOT WATER HEATER IS INCREASED BY NOT LESS THAN 4 PERCENTAGE POINTS.
- WINDOWS:**
-WINDOWS TO BE SEALED TO THE AIR & VAPOR BARRIER
-WINDOWS THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF 1.8 W/(m2.K) OR
-AN ENERGY RATING OF NOT LESS THAN 21 FOR OPERABLE WINDOWS & 31 FOR FIXED WINDOWS
-BASEMENT WINDOWS WITH LOAD BEARING STRUCTURAL FRAME SHALL BE DOUBLE GLAZED WITH LOW-E COATING
-SKYLIGHTS SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF 2.8 W/(m2.K)
-FOR GROSS GLAZED AREAS LESS THAN 17%

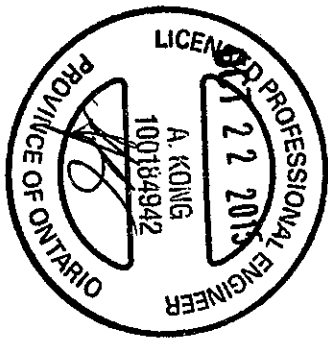

FOR STRUCTURAL ONLY

SCHEDULES


DOORS 46) 47)		WOOD BEAMS	
A 865x2030x45 (2'10"x6'8"x1'-3/4")	WD1 3/2" X 8" SPR	WD6 5/2" X 10" SPR	WD10 2/1 3/4" X 1 1/4" (2.08) LVL
B 815x2030x35 (2'8"x6'8"x1'-3/8")	WD2 4/2" X 8" SPR	WD7 3/2" X 12" SPR	WD11 3/1 3/4" X 1 1/4" (2.08) LVL
C 760x2030x35 (2'6"x6'8"x1'-3/8")	WD3 5/2" X 8" SPR	WD8 4/2" X 12" SPR	WD12 2/1 3/4" X 1 1/2" (2.08) LVL
D 710x2030x35 (2'4"x6'8"x1'-3/8")	WD4 3/2" X 10" SPR	WD9 5/2" X 12" SPR	WD13 3/1 3/4" X 1 1/2" (2.08) LVL
E 460x2030x35 (1'6"x6'8"x1'-3/8")	WD5 4/2" X 10" SPR	WD14 2/1 3/4" X 1 1/2" (2.08) LVL	WD15 3/1 3/4" X 1 1/2" (2.08) LVL
F 610x2030x35 (2'0"x6'8"x1'-3/8")			
G OVER SIZED EXTERIOR DOOR -REFER TO ELEVATIONS FOR SIZE			
		LINTELS	
L1 2/2" X 8" SPR	L10 4-7/8" X 3-1/2" X 5/16" L	L15 5-7/8" X 4" X 1/2" L	
L3 2/2" X 10" SPR	L11 4-7/8" X 3-1/2" X 3/8" L	L16 7-1/8" X 4" X 3/8" L	
L5 2/2" X 12" SPR	L12 4-7/8" X 3-1/2" X 1/2" L	L17 7-1/8" X 4" X 1/2" L	
L7 3-1/2" X 3-1/2" X 1/4" L	L13 5-7/8" X 3-1/2" X 3/8" L		
L9 4" X 3-1/2" X 1/4" L	L14 5-7/8" X 3-1/2" X 1/2" L		
		STEEL BEAMS	
S11 W6 X 15	S13 W8 X 18	S15 W8 X 24	
S12 W6 X 20	S14 W8 X 21		

FLOOR AREA CALCULATIONS

ELEVATION	B				
FIRST FLOOR	1074				
SECOND FLOOR	1391				
TOTAL	2465				
DEDUCT O.T.B.	8				
TOTAL	2457				
FIN. BASEMENT	0				
TOTAL	2457				
LOFT PLAN	N/A				
TOTAL	2457				
COVERAGE (ft ²)	2457				
W/O PORCH (m ²)	229.0				
COVERAGE (ft ²)	1461				
W/O PORCH (m ²)	135.7				
COVERAGE (ft ²)	1532				
W/ PORCH (m ²)	142.3				


PLAN/ELEVATION LEGEND	
SMOKE ALARM	CARBON MONOXIDE DETECTOR
WATERPROOF DOUBLE OUTLET	DOUBLE JOIST
VENTS AND INTAKES	PRESSURE TREATED LUMBER
HOSE MB	G.T. GUTTER TRUSS
EXHAUST FAN	A.F.F. ABOVE FINISHED FLOOR
COLD CELLULAR VENT	EXT. LIGHT FIXTURE (WALL MOUNTED)
STOVE VENT	HYDRO METER
FIRE PLACE VENT	GAS METER
DRYER VENT	
FLOOR DRAIN	SOLID BEARING
TO BE SAME WIDTH AS SUPPORTED MEMBERS	POINT LOAD
FLAT ARCH	2 STORY WALL
U/S UNDER SIDING	FG FIXED GLAZING
GB GLASS BLOCK	BG BLACK GLASS

		MODEL		37-8 (HAMPTON) ELEV. 'B'	
CLIENT		No. ISSUED OR REVISION COMMENTS		DATE	DWN CHK
ESQUIRE HOMES		1.		OCT. 19/15	NC
NORTHGLEN - PHASE 2					
CLARINGTON, ONTARIO					
REVISIONS: JANUARY 08, 2015 - RN STAFF		QUALIFIED DESIGNER BCIN: 21032		SIGNATURE:	
IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J		FIRM BCIN: 26995			
CLIENT SPECIFIC REVISIONS		DATE: OCTOBER 19, 2015			
PROJECT NUMBER		SCALE		N/A	
14093					
PAGE				D3	

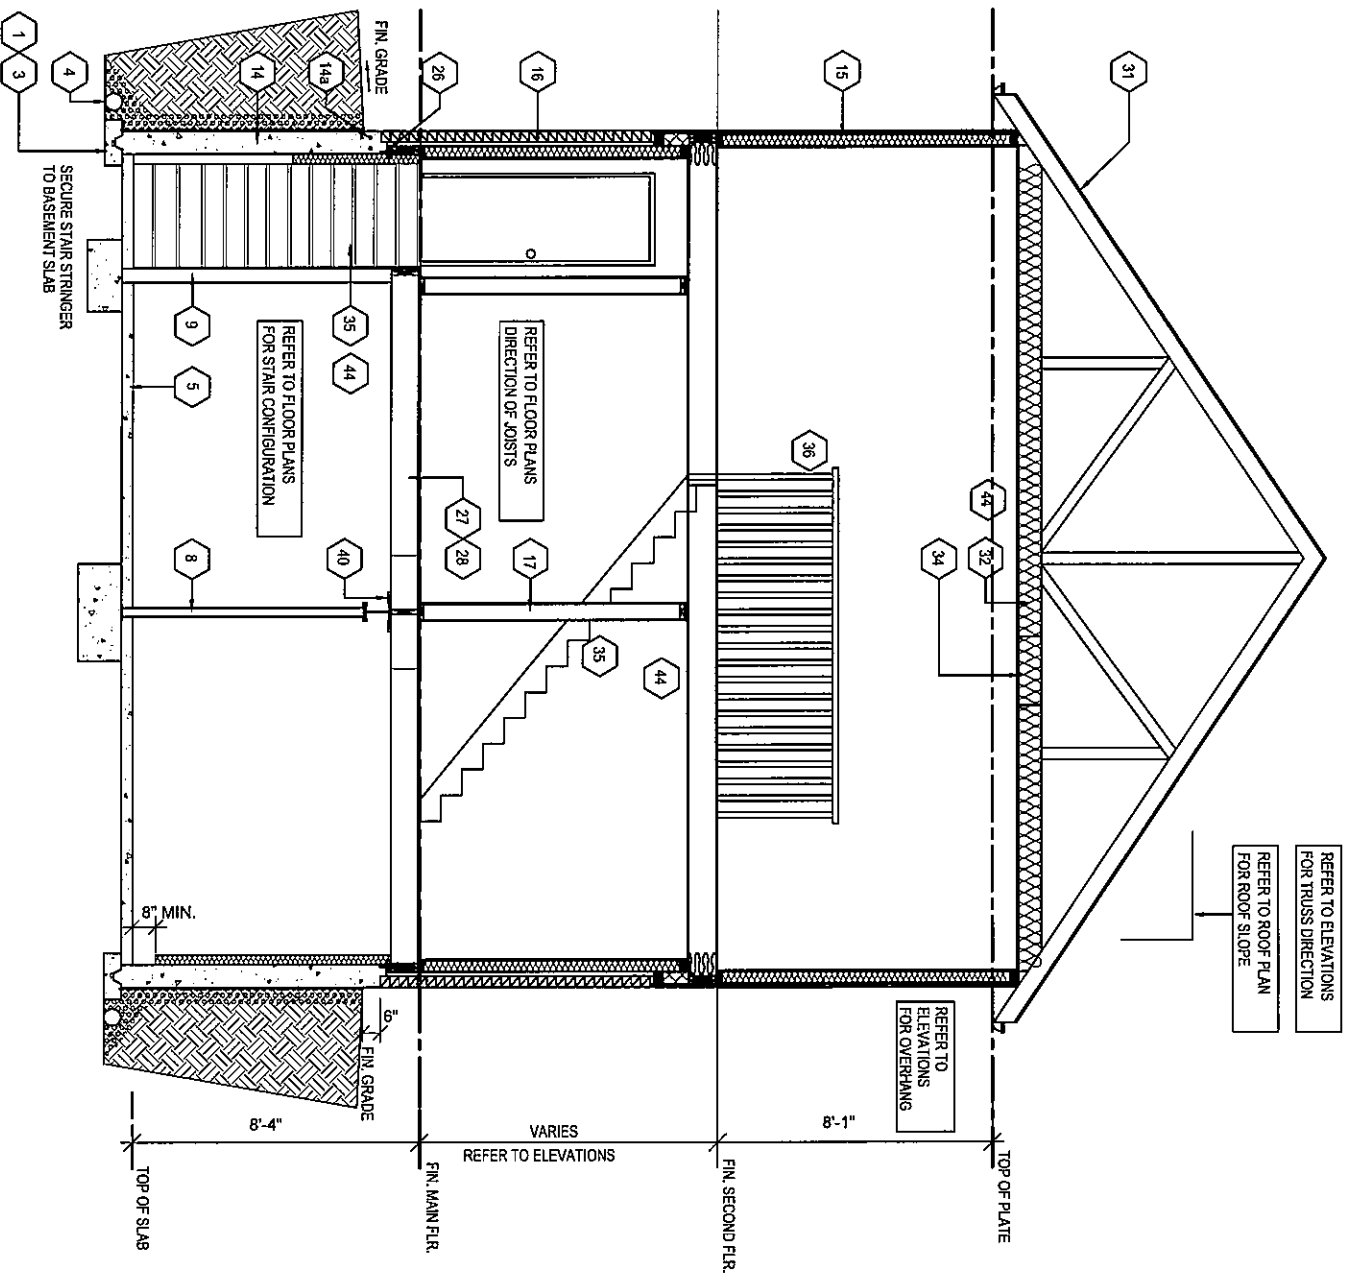

TYPICAL SECTION
BRICK ON GROUND FLOOR
SIDING ON SECOND FLOOR

FOR STRUCTURAL ONLY

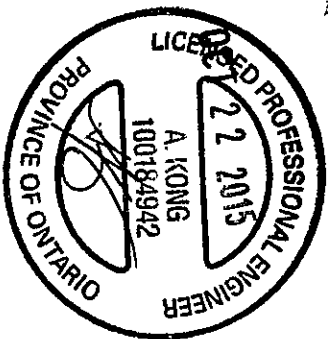

 RN design Imagine • Inspire • Create TEL: (905) 738-3177 FAX: (905) 738-5149	MODEL	37-8 (HAMPTON) ELEV. 'B'			
	CLIENT	ESQUIRE HOMES NORTHGLEN - PHASE 2 CLARINGTON, ONTARIO			
THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY THE CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD. REVISED: JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO SP-12 COMPLIANCE PACKAGE 2	No. ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE
	1. UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	-	NC	N/A
1. NELSON DUNA REGULATE THAT HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN OF THE BUILDING. THE DESIGN IS LIMITED UNDER DIVISION C, PART 1, SUBSECTION 12.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORIES.	QUALIFIED DESIGNER BCIN: 21032	SIGNATURE:	PAGE		
FIRM BCIN: 26995	DATE: OCTOBER 19, 2015		PROJECT NUMBER 14093		
			D4		