



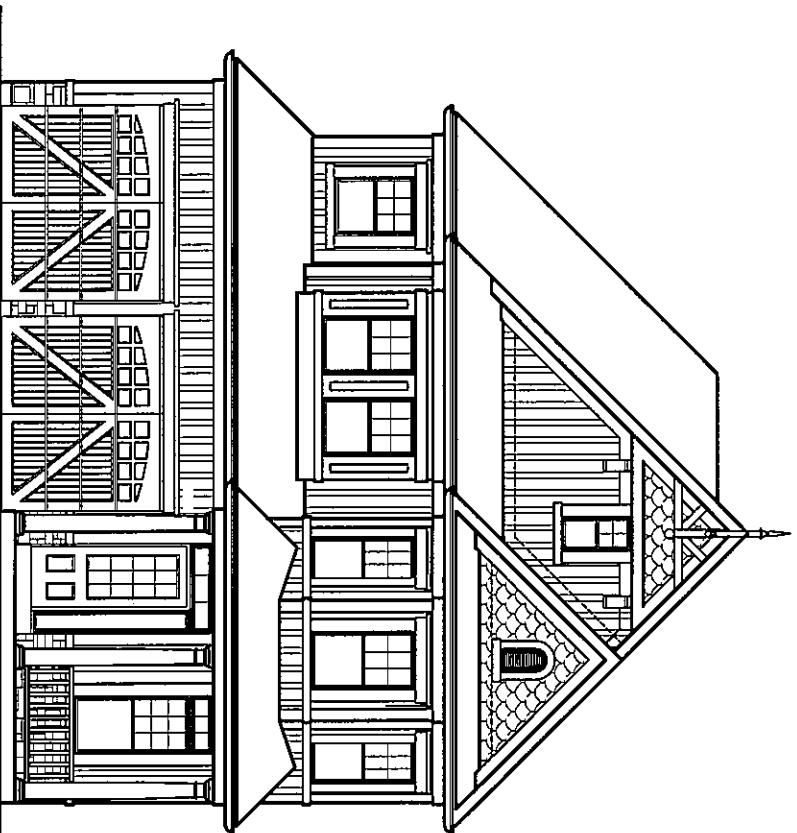

FRONT ELEVATION 'A'

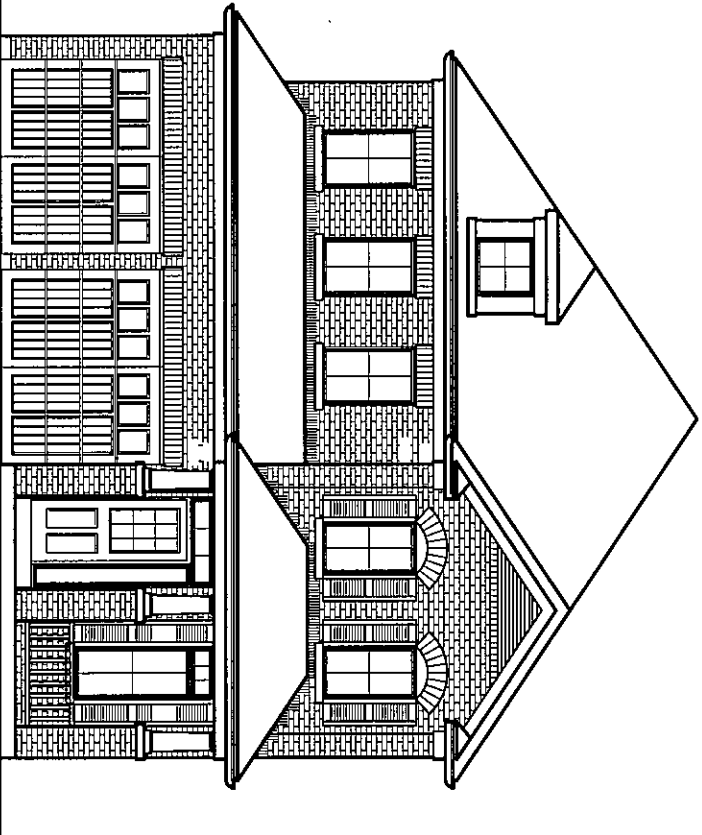

FRONT ELEVATION 'B'

OBC 2012

DRAWING LIST:

- 37-4 (FOUNDRY)
- T1 TITLE SHEET
 - A1 BASEMENT FLOOR ELEV. 'A' & 'B'
 - A2 GROUND FLOOR ELEV. 'A'
 - A3 SECOND FLOOR ELEV. 'A'
 - A4 GROUND FLOOR ELEV. 'B'
 - A5 SECOND FLOOR ELEV. 'B'
 - A6 FRONT ELEVATION 'A'
 - A7 RIGHT SIDE ELEVATION 'A'
 - A8 REAR ELEVATION 'A'
 - A9 LEFT SIDE ELEVATION 'A'
 - A10 FRONT ELEVATION 'B'
 - A11 RIGHT SIDE ELEVATION 'B'
 - A12 REAR ELEVATION 'B'
 - A13 LEFT SIDE ELEVATION 'B'
 - D1 CONSTRUCTION SHEET
 - D2 CONSTRUCTION SHEET
 - D3 CONSTRUCTION SHEET
 - D4 TYPICAL SECTION


GROSS GLAZING AREA 'A'

TOTAL PERIPHERAL WALL AREA	2615.03 SF	242.94 m²
FRONT GLAZING AREA	77.84 SF	7.23 m²
LEFT SIDE GLAZING AREA	19.78 SF	1.84 m²
RIGHT SIDE GLAZING AREA	33.22 SF	3.09 m²
REAR GLAZING AREA	106.46 SF	9.89 m²
TOTAL GLAZING AREA	237.30 SF	22.05 m²
TOTAL GLAZING PERCENTAGE	9.07 %	

GROSS GLAZING AREA 'B'

TOTAL PERIPHERAL WALL AREA	2575.44 SF	239.26 m²
FRONT GLAZING AREA	62.1 SF	5.77 m²
LEFT SIDE GLAZING AREA	19.78 SF	1.84 m²
RIGHT SIDE GLAZING AREA	33.22 SF	3.09 m²
REAR GLAZING AREA	106.47 SF	9.89 m²
TOTAL GLAZING AREA	221.57 SF	20.58 m²
TOTAL GLAZING PERCENTAGE	8.60 %	

ESQUIRE HOMES
NORTHGLEN - PH. 2
CLARINGTON, ONTARIO



RN design
Imagine • Inspire • Create

8395 JANE STREET
SUITE 203
VAUGHAN, ON
TEL: 905-738-3177
FAX: 905-738-5449

CONTACT PERSON: NELSON CUNHA

No.	REVISION COMMENTS:	DATE	DWN	CHK	No.	REVISION COMMENTS:	DATE	DWN	CHK	SCALE
1.	UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	--	NC						AS NOTED
										PROJECT No. 14093
										T1

THESE DRAWINGS ARE NOT TO BE SCALED
ALL DIMENSIONS MUST BE REPORTED TO THE CLIENT PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.
REVISED: JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J

I, NELSON CUNHA, DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE ENTIRE DRAWING. I AM A REGISTERED PROFESSIONAL ARCHITECT IN THE PROVINCE OF ONTARIO, CANADA. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORIES.

QUALIFIED DESIGNER BCIN: 21032
FIRM BCIN: 26995
DATE: OCTOBER 19, 2015
SIGNATURE:



RN design
Imagine • Inspire • Create
TEL.(905)738-3177
FAX.(905)738-5449

ESQUIRE HOMES
NORTHGLEN - PHASE 2
CLARINGTON, ONTARIO

MODEL
37-4 (FOUNDRY)

CLIENT

No.	ISSUED OR REVISION COMMENTS
4	UPDATED TO OBC 2012 - 2015 ENACTMENT

1.	UPDATED TO OBC 2012 - 2015 ENACTMENT
----	--------------------------------------


DATE	DWN	CHK
OCT 10/45		NO

OCT. 19/15	-	NC
------------	---	----

SCALE
3/16" = 1'0"

1

A

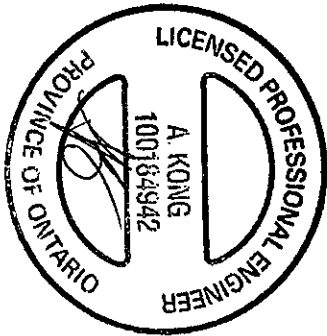


NOTE:
SPACE ALL FLOOR JOISTS @ 12" O.C.
UNDER ALL CERAMIC TILES AREA


BASEMENT FLOOR ELEV. 'A' & 'B'

**FOR STRUCTURAL ONLY
EXCLUDING ROOF
TRUSS DESIGNS**

NCT-222015

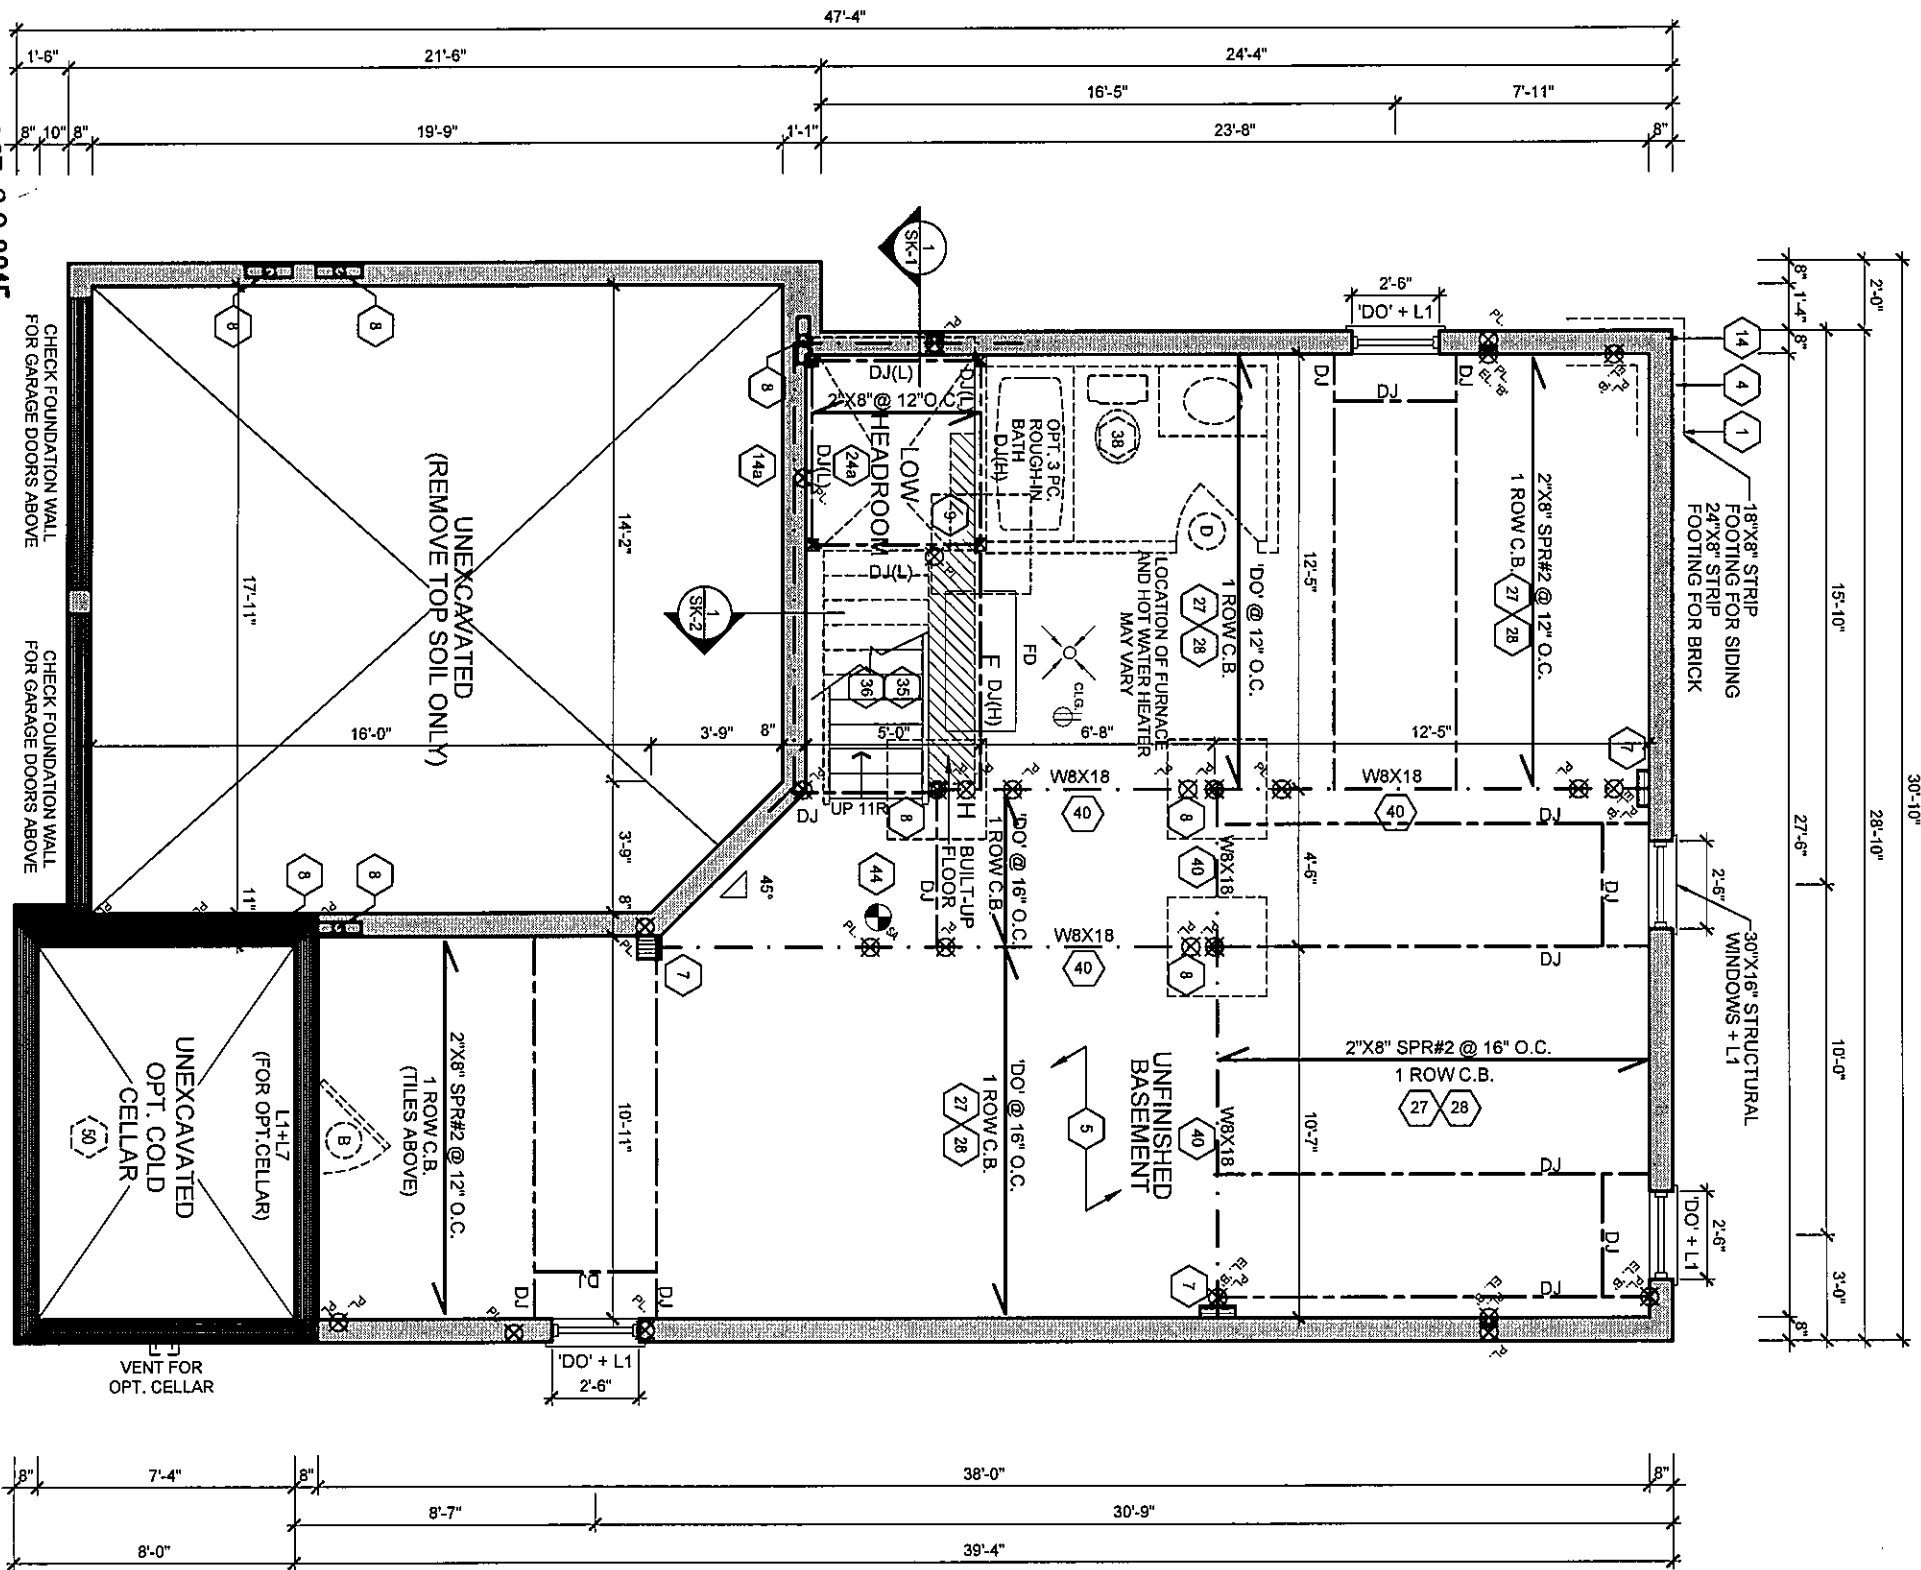



This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARKSON.

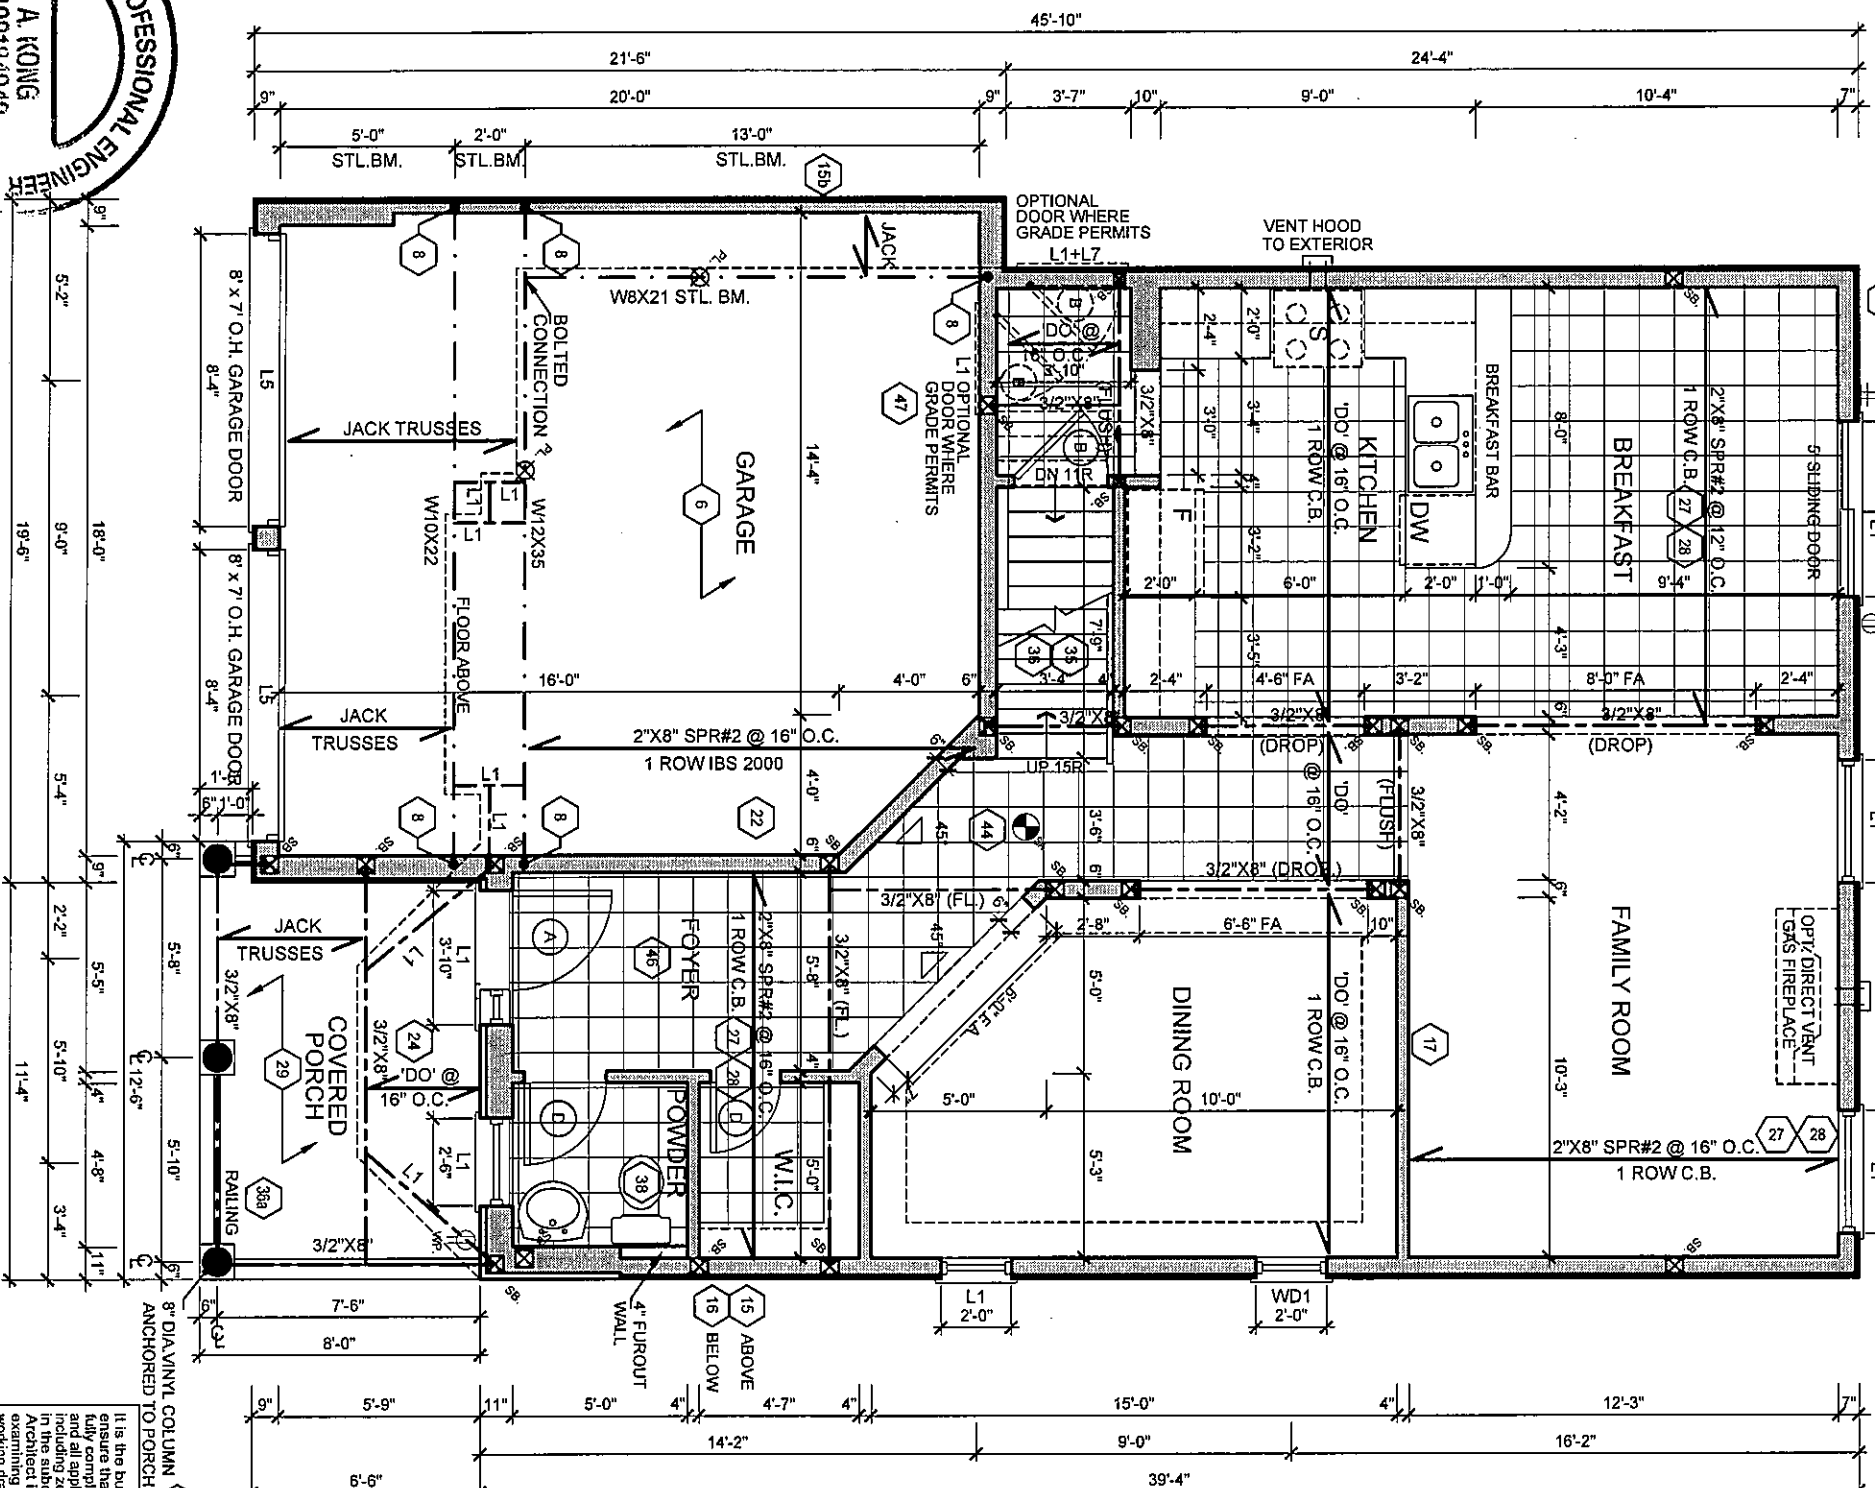

NOTE:
CONC. FRONT PORCH
POURED PRIOR TO BRICK


It is the builder's complete responsibility to ensure that all plans submitted for approval comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or subdivision agreement. The Control Architect's house can be properly built or located on its lot.

A2

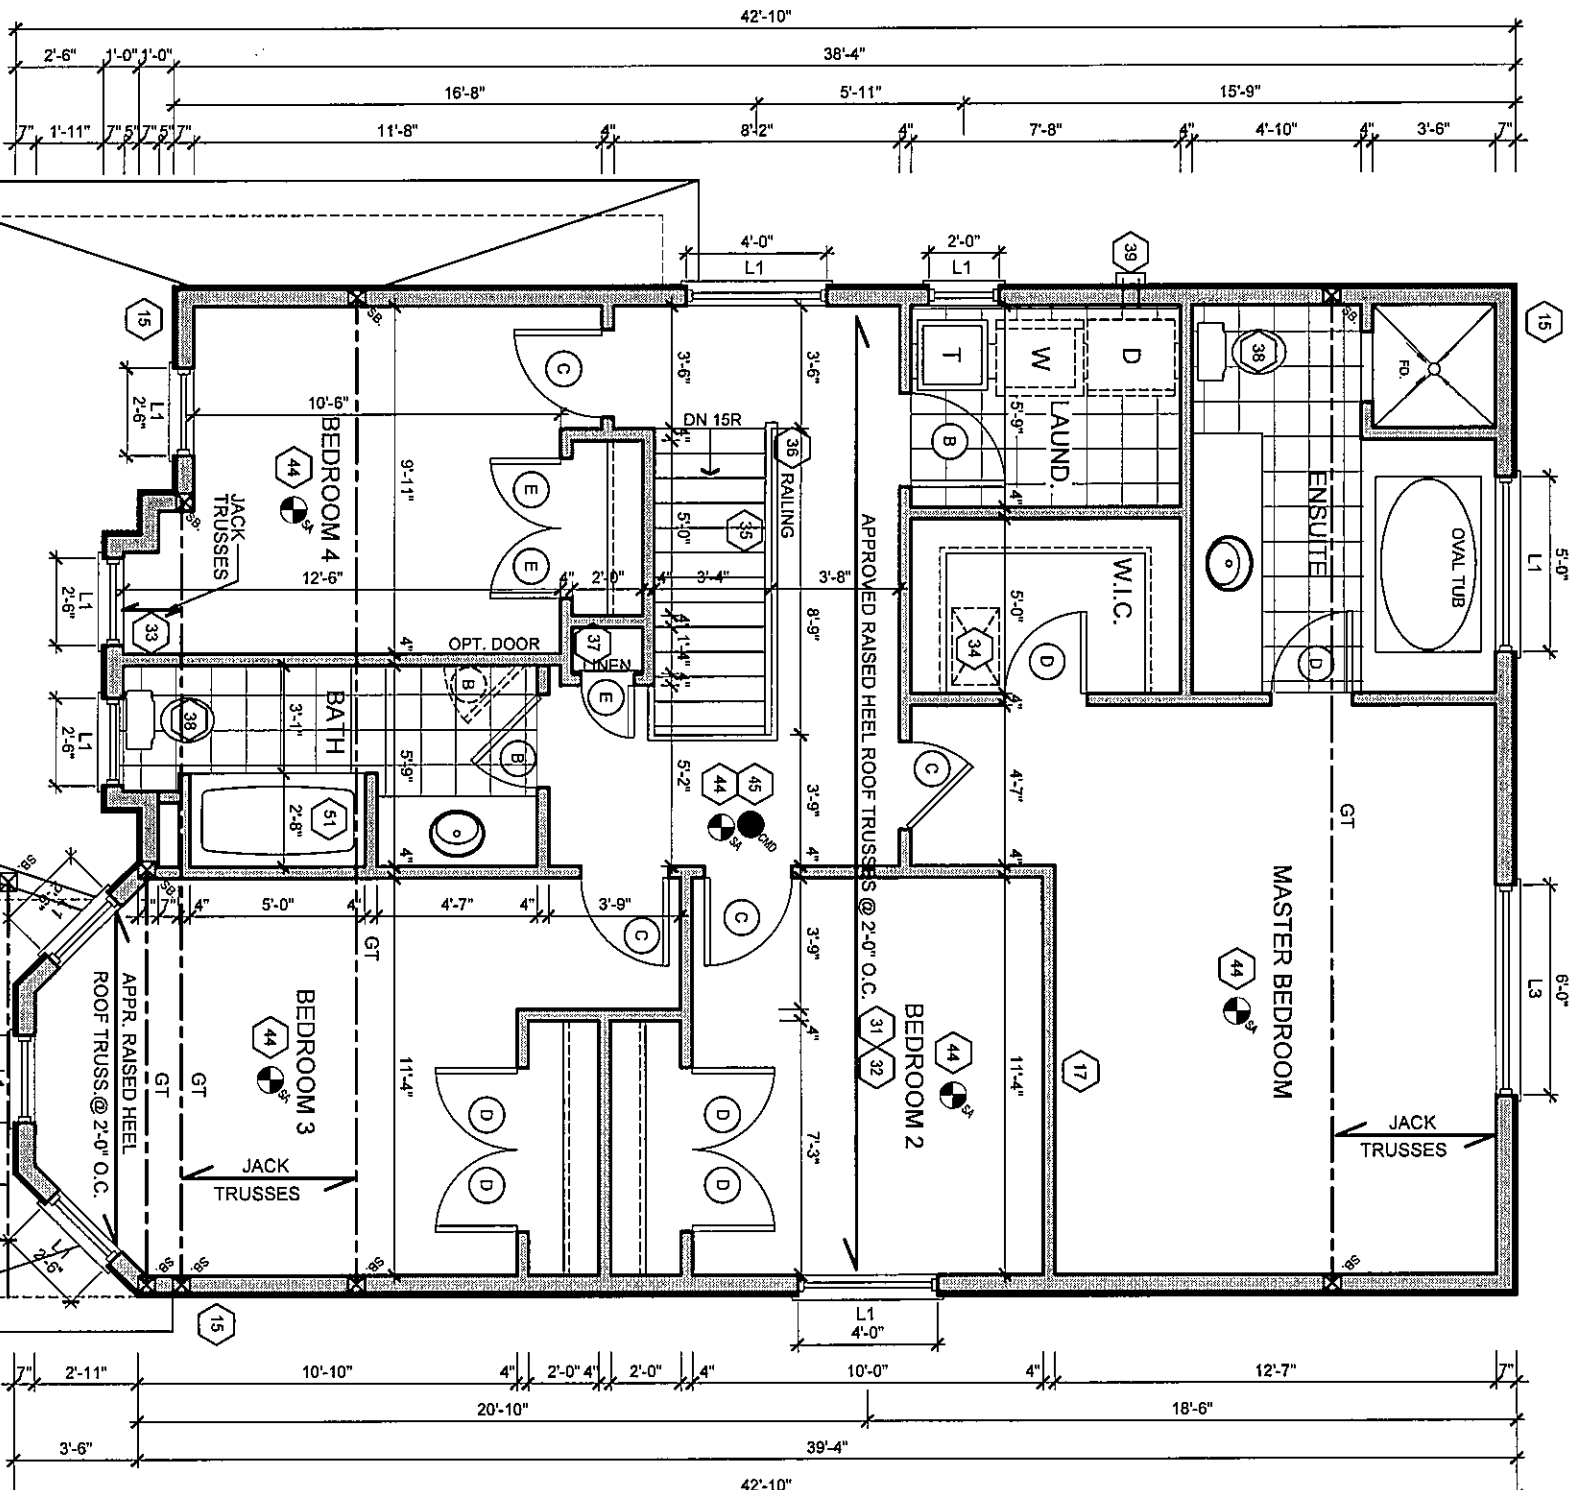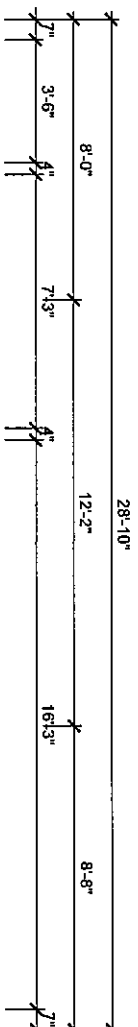

OCT 22 2015

FOR STRUCTURAL ONLY
EXCLUDING ROOF
TRUSS DESIGNS

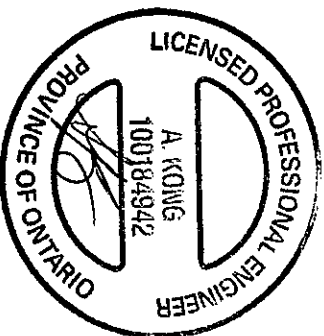


SECOND FLOOR ELEV. 'A'

NOTE: SPACE ALL FLOOR JOISTS @ 12" O.C.
UNDER ALL CERAMIC TILES AREA

NOTE: CONC. FRONT PORCH
POURED PRIOR TO BRICK

REFER TO TRUSS
DRAWINGS FOR
APPROVED TRUSS
LAYOUT.

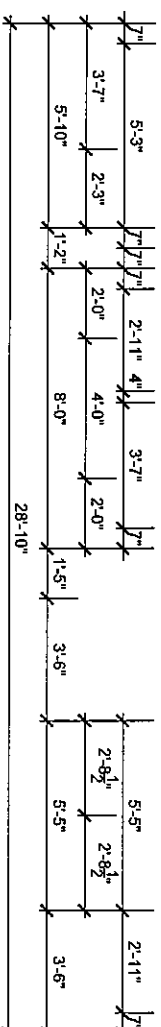

It is the builder's complete responsibility to ensure that all construction is in accordance with the approved plans and specifications. The builder shall be responsible for obtaining all necessary permits and approvals from the appropriate authorities. The builder shall be responsible for ensuring that all construction is completed in accordance with the approved plans and specifications. The builder shall be responsible for ensuring that all construction is completed in accordance with the approved plans and specifications.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.

MODEL

37-4 (FOUNDRY)

CLIENT

ESQUIRE HOMES
NORTHGLEN - PHASE 2
CLARINGTON, ONTARIO

No.	ISSUED OR REVISION COMMENTS	DATE	DWN	CHK
1.	UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	-	NC

SCALE
3/16" = 1'0"

PROJECT NUMBER
14093

RN design

Imagine - Inspire - Create

TEL: (905) 738-3177

FAX: (905) 738-5449




THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR
TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES
MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.
REVISED: JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J

I, DESIGNER, HEREBY DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN
RESPONSIBILITY FOR THE ABOVE DRAWING. I AM A REGISTERED PROFESSIONAL
ENGINEER UNDER DIVISION C, PART 3, SUBSECTION 32.4 OF THE BUILDING CODE.
I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE
CLASSIFICATION CODES.


QUALIFIED DESIGNER BCIN: 21032
FIRM BCIN: 26995

SIGNATURE:
DATE: OCTOBER 19, 2015

PAGE
A3

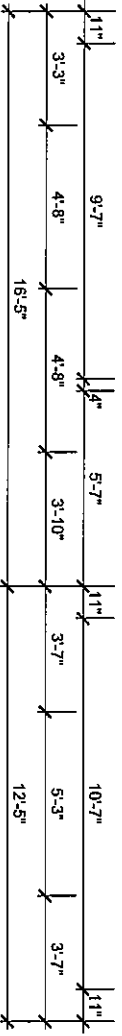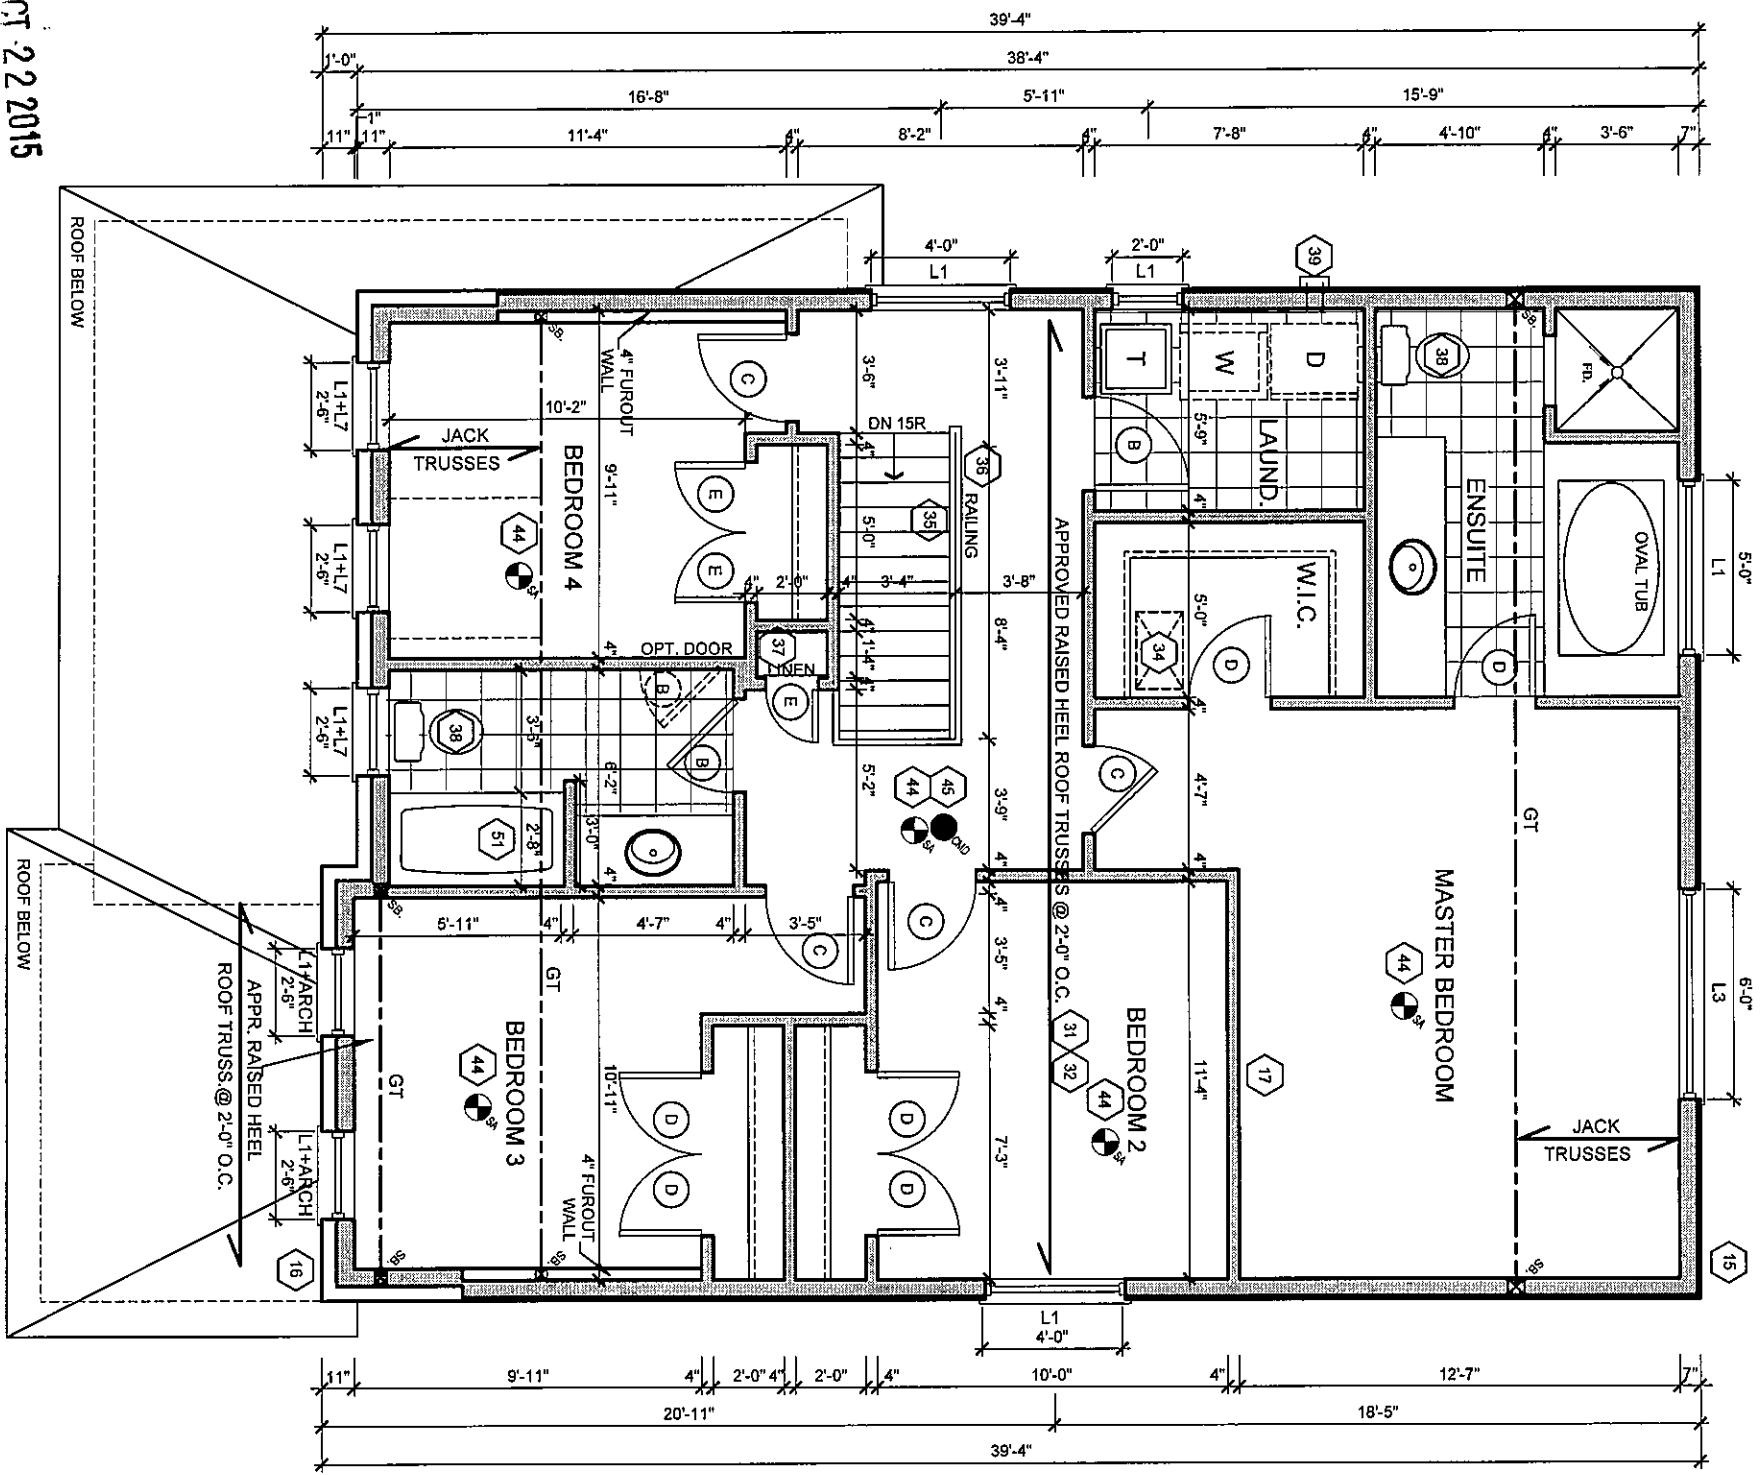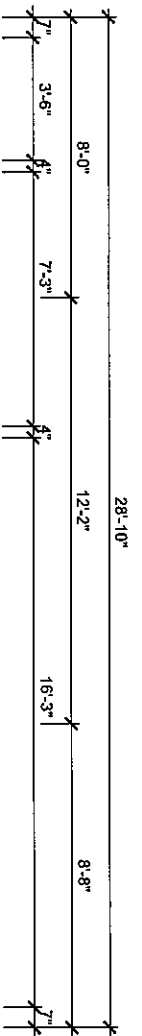

SECOND FLOOR ELEV. 'B'

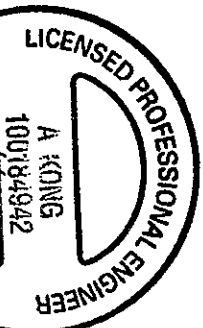

OCT 22 2015
FOR STRUCTURAL ONLY
EXCLUDING ROOF
TRUSS DESIGNS

REFER TO TRUSS
DRAWINGS FOR
APPROVED TRUSS
LAYOUT.

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any applicable laws. The Architect is not responsible in any way for examining or approving site (lotting) plans or building drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.



MODEL

37-4 (FOUNDRY)

CLIENT

ESQUIRE HOMES
NORTHGLEN - PHASE 2
CLARINGTON, ONTARIO

THESE DRAWINGS ARE NOT TO BE SCALED
ALL DIMENSIONS MUST BE VERIFIED BY THE FIELD PRIOR
TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES
MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.
REVISED: JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J

Imagine - Inspire - Create
RN design
TEL: (905) 738-3177
FAX: (905) 738-5449

NO.	ISSUED OR REVISION COMMENTS
1.	UPDATED TO OBC 2012 - 2015 ENACTMENT

DATE	DWN	CHK
OCT. 19/15	-	NC


SCALE
3/16" = 1'0"

PROJECT NUMBER
14093

I, A. KONG, CLARINGTON, ONTARIO, A PROFESSIONAL ENGINEER, HEREBY CERTIFY THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE ABOVE DRAWINGS. I AM QUALIFIED AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORIES.

QUALIFIED DESIGNER BCIN: 21032
FIRM BCIN: 28995
DATE: OCTOBER 19, 2015
SIGNATURE:


PAGE
A5

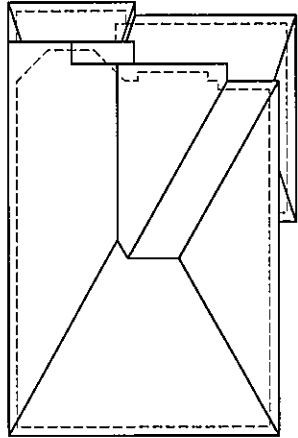

ROOF PLAN 'A'

ALL CONVENTIONAL ROOF FRAMING TO CONFORM TO PART 9 OF THE OBC. ROOF RAFTERS THAT MEET OR CROSS OVER TRUSSES ARE TO BE 2"x4" SPF @ 24" o.c. WITH A 2"x4" SPF VERTICAL POST TO THE TRUSS UNDER, AT EACH CROSS POINT. POSTS LONGER THAN 6' TO BE Laterally Braced so that the distance between end points & between rows of bracing does not exceed 6'.

REFER TO TRUSS DRAWINGS FOR APPROVED TRUSS LAYOUT.

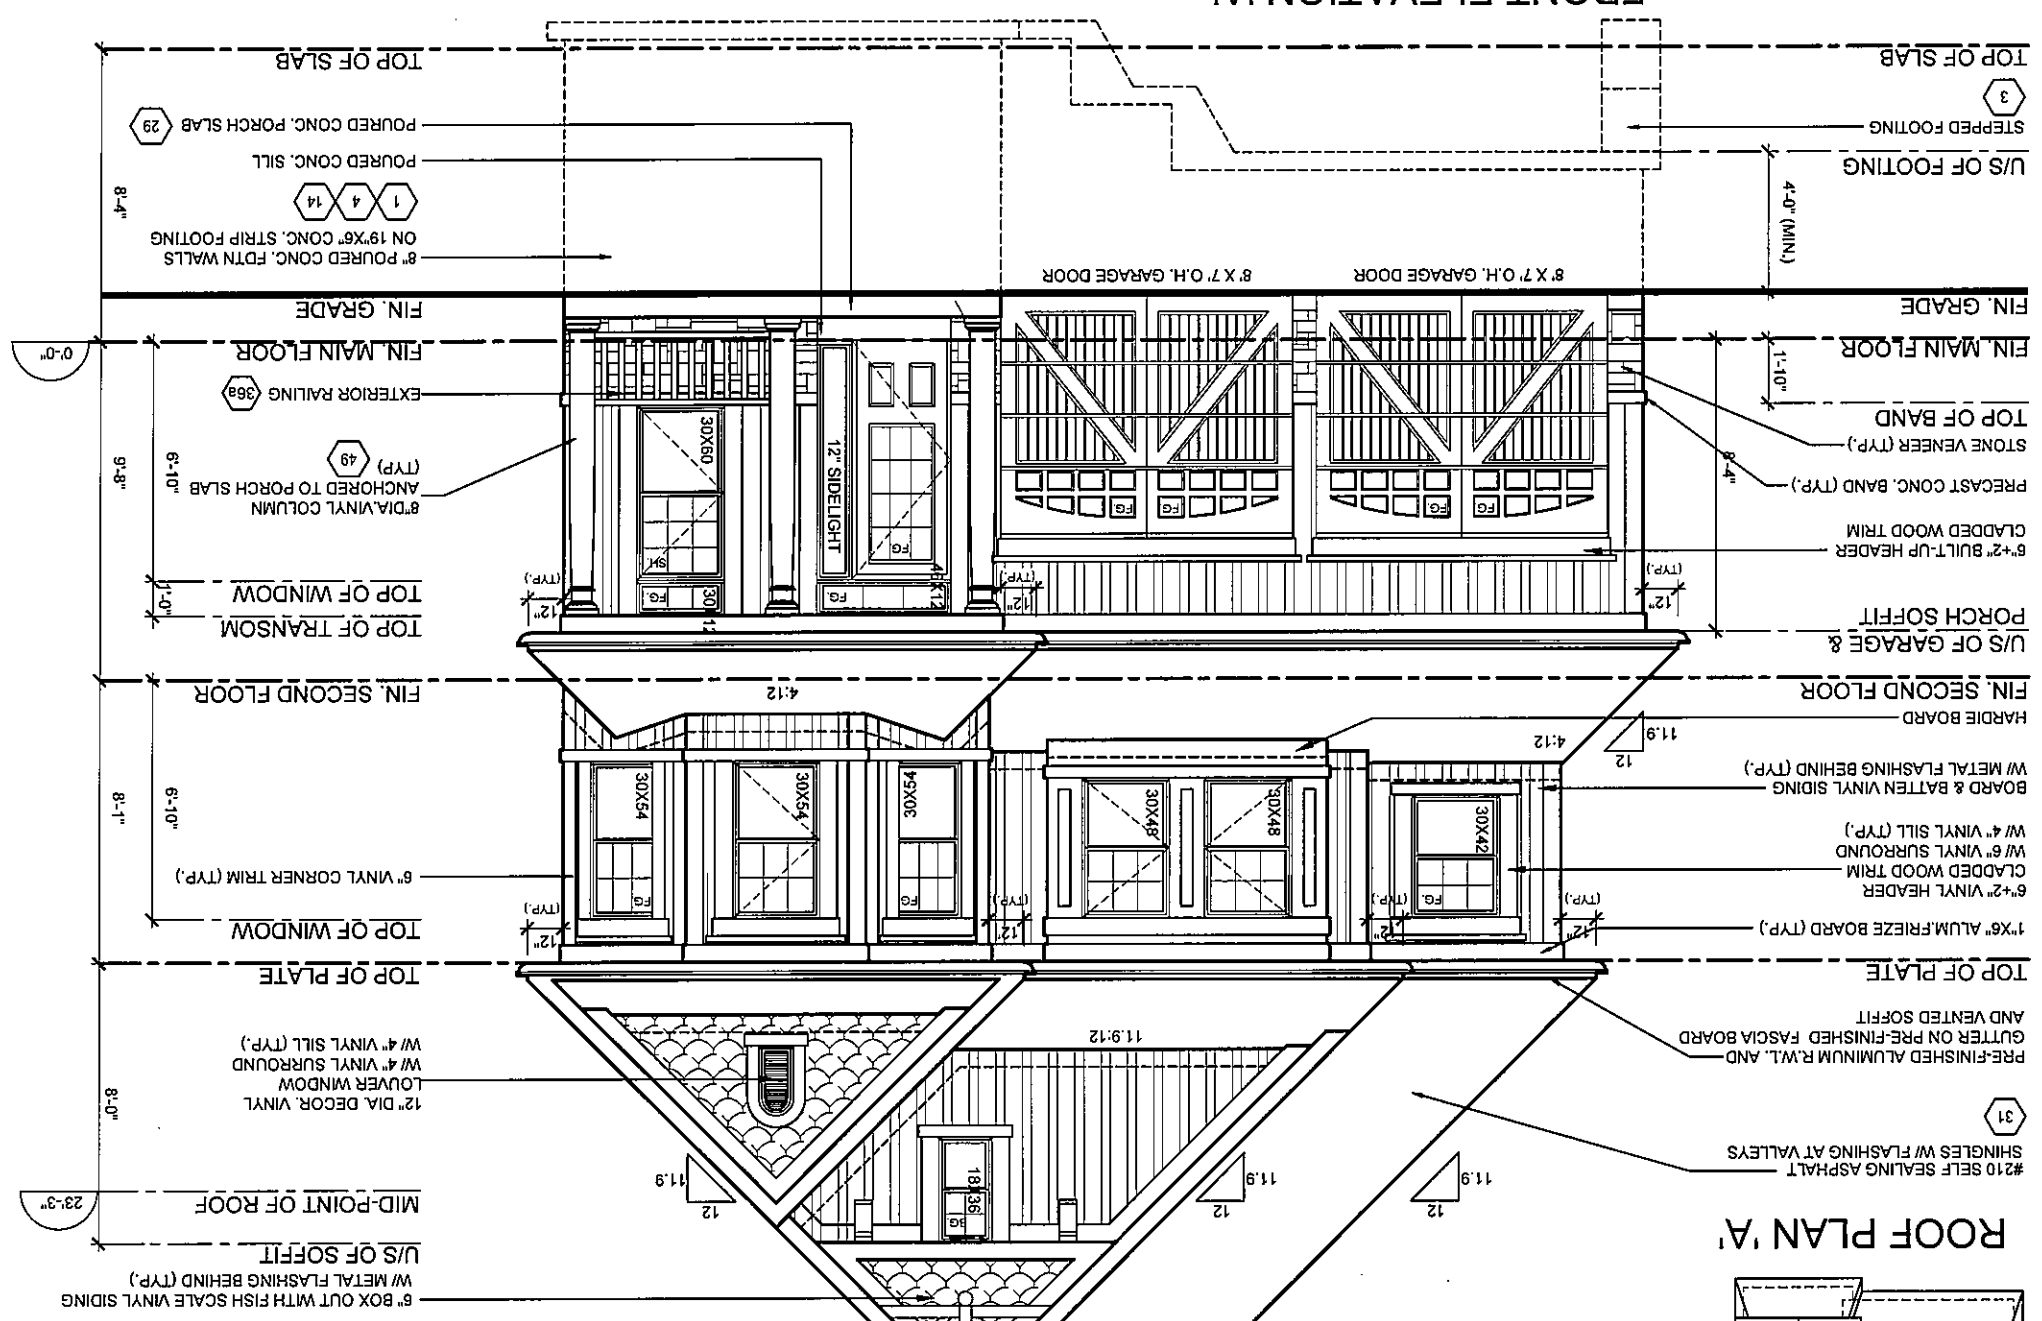

FRONT ELEVATION 'A'

PEAK HEIGHT OF ROOF 29'-9"

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for the use of or applying such to any plans or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.

CLARINGTON, ONTARIO



RN design
Imagine - Inspire - Create
TEL: (905) 738-3177
FAX: (905) 738-5449

ESQUIRE HOMES
NORTHGLEN - PHASE 2
CLARINGTON, ONTARIO


MODEL	37-4 (FOUNDRY)	SCALE	3/16" = 1'0"
CLIENT		PROJECT NUMBER	14093

No. ISSUED OR REVISION COMMENTS	DATE	DWN	CHK
1. UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	-	NC

THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD. REVISED: JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO BR-42 COMPLIANCE PACKAGE J

1. DESIGN: GUYA DESIGNS INC. (REGISTERED ARCHITECT) HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE ENTIRE PROJECT. 2. PERMITTING: GUYA DESIGNS INC. (REGISTERED ARCHITECT) HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE ENTIRE PROJECT. 3. SUBSECTION 3.2.4 OF THE BUILDING CODE. 4. AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSIFICATION CATEGORY.

QUALIFIED DESIGNER BCIN: 21032 SIGNATURE: DATE: OCTOBER 19, 2015 FIRM BCIN: 26995

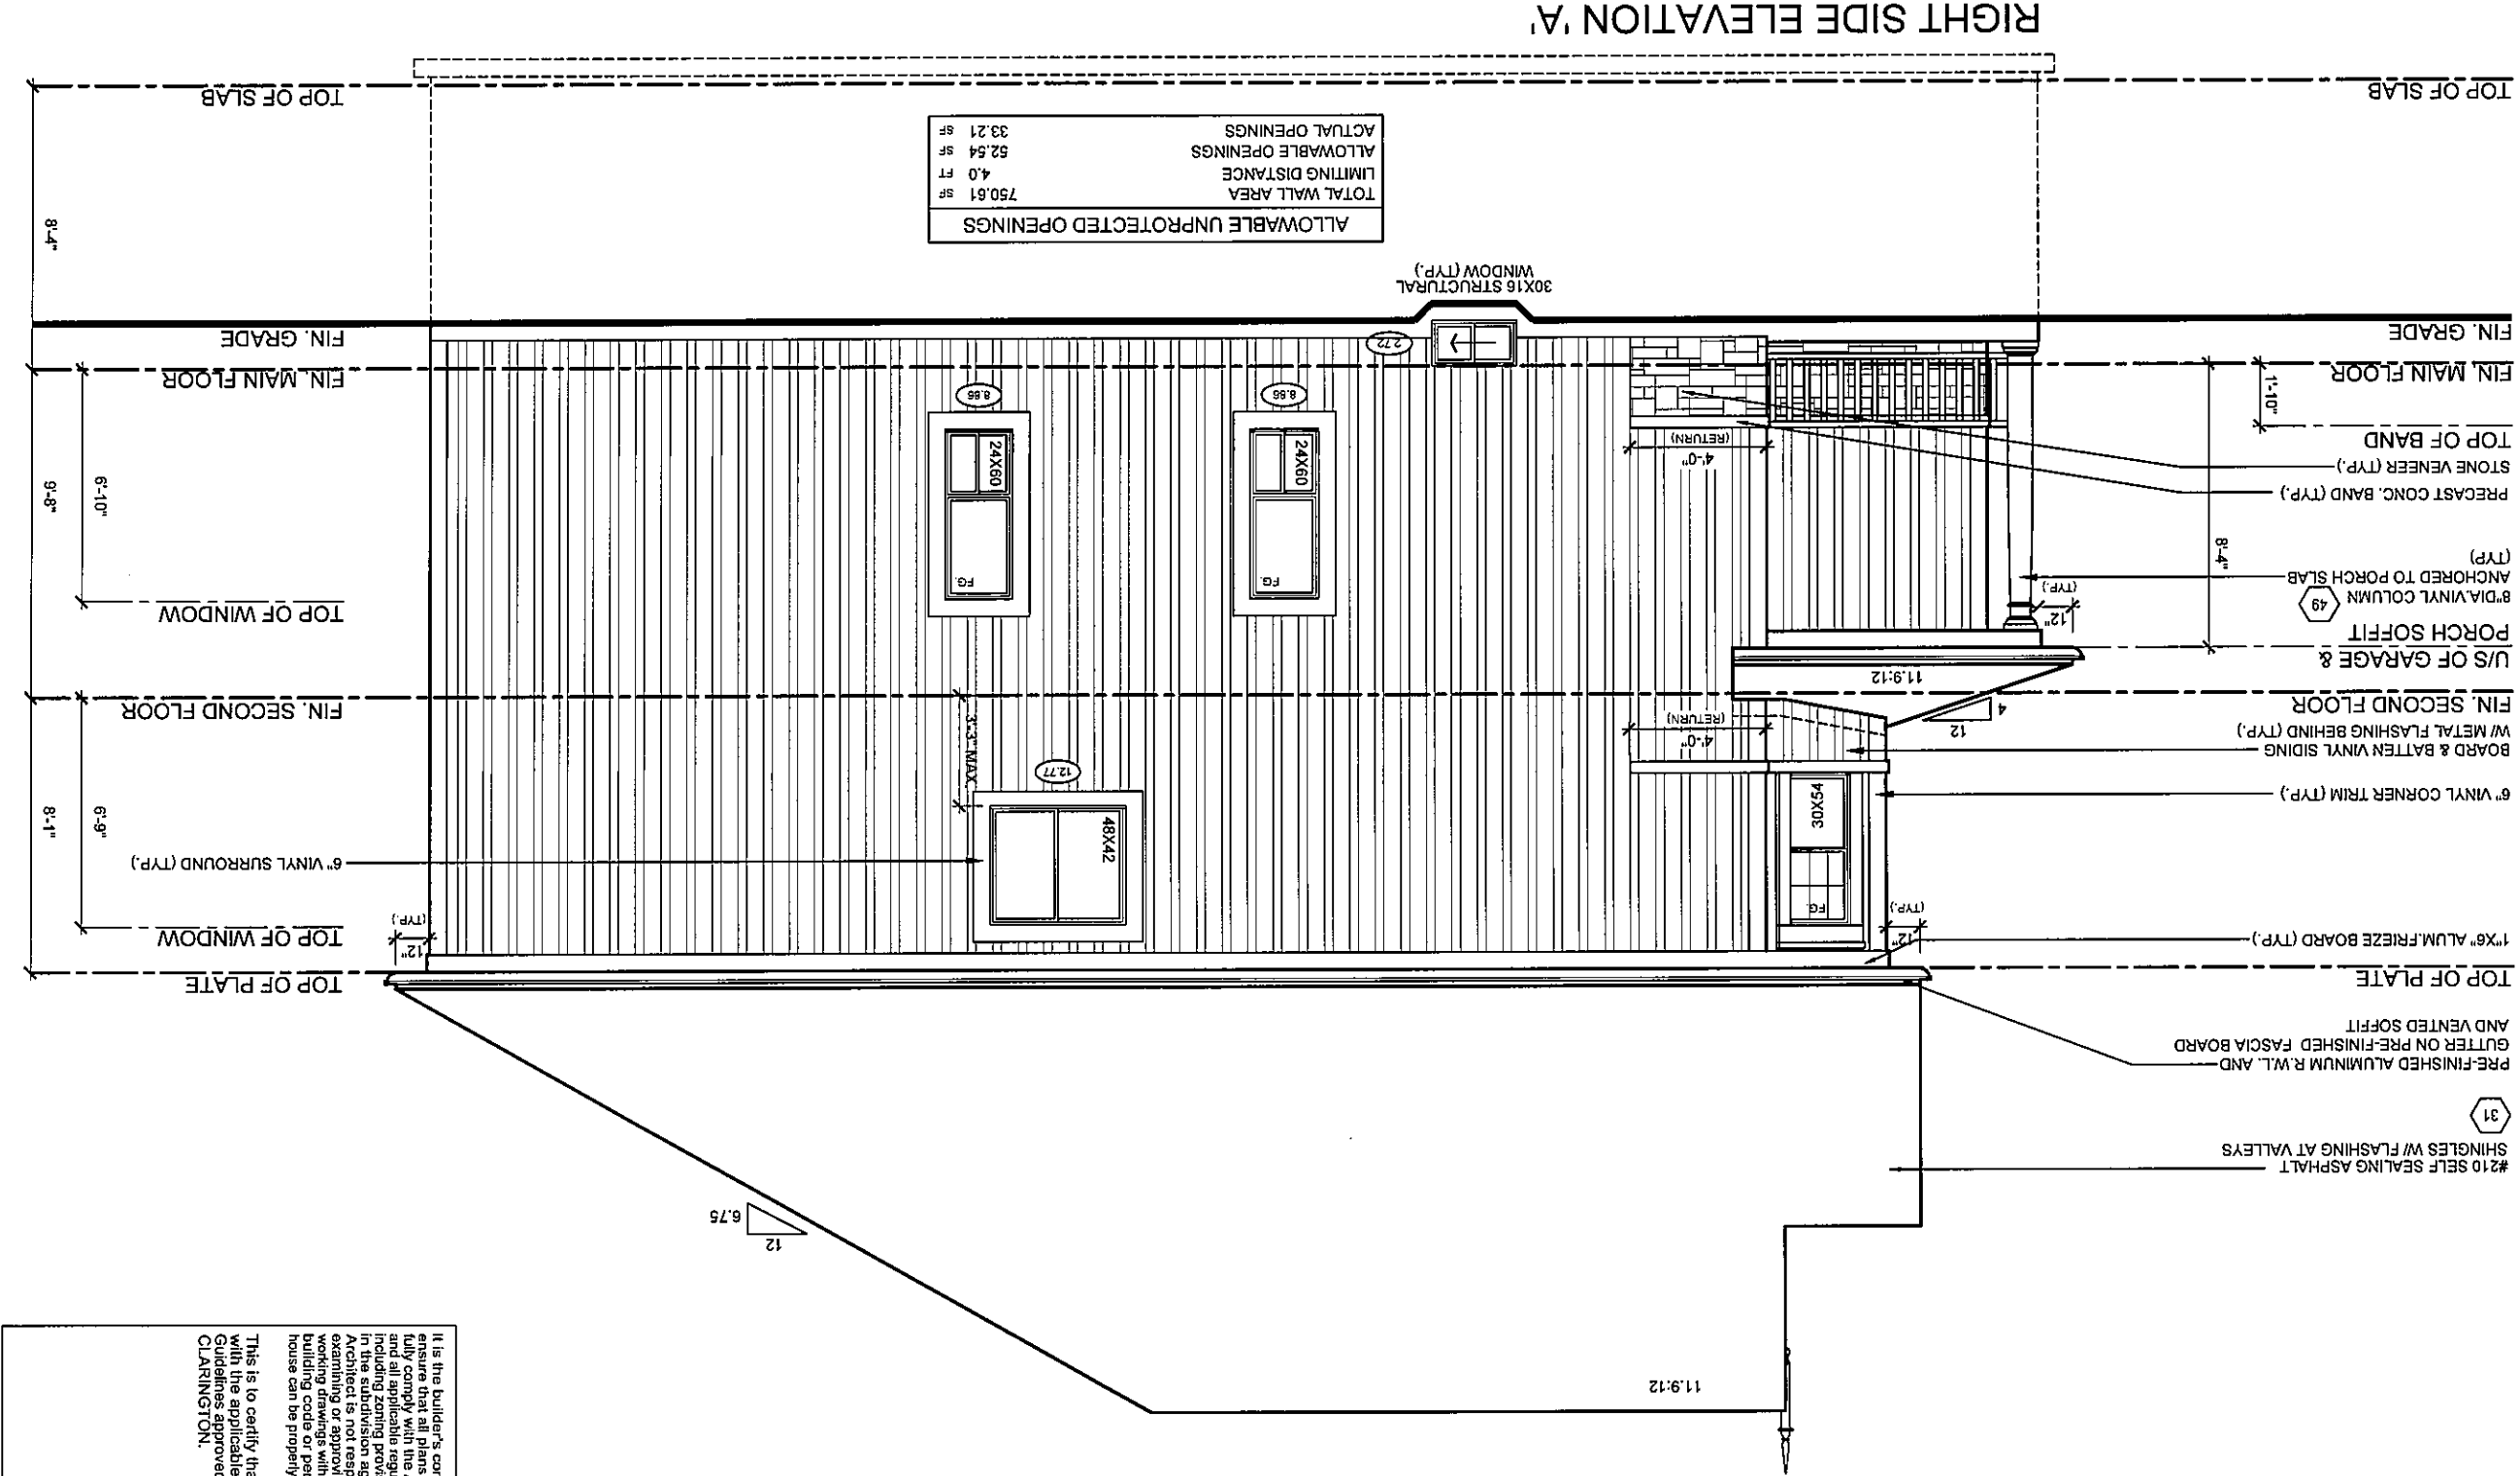

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.



RN design
Imagine - Inspire - Create
TEL: (905) 738-3177
FAX: (905) 738-5449

MODEL 37-4 (FOUNDRY)

CLIENT

ESQUIRE HOMES
NORTHGLEN - PHASE 2
CLARINGTON, ONTARIO

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.
REVISED: JANUARY 06, 2015 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J

I HEREBY CERTIFY THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE ENTIRE PROJECT AND I AM A QUALIFIED PROFESSIONAL ENGINEER UNDER DIVISION C, PART 3, SUBSECTION 3.2.4. OF THE BUILDING CODE. CLASSIFICATION: ENGINEER

QUALIFIED DESIGNER BCIN: 21032
FIRM BCIN: 28995
DATE: OCTOBER 19, 2015

SIGNATURE:

MODEL

No. ISSUED OR REVISION COMMENTS


DATE DWN CHK

SCALE 3/16" = 1'0"

PROJECT NUMBER 14093


PAGE

A7

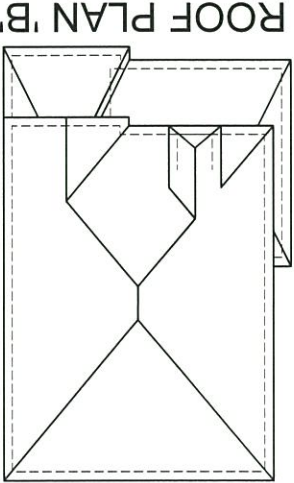

REFER TO TRUSS
DRAWINGS FOR
APPROVED TRUSS
LAYOUT.

ALL CONVENTIONAL ROOF FRAMING TO CONFORM TO PART 9 OF THE OBC. ROOF RAFTERS THAT MEET OR CROSS OVER TRUSSES ARE TO BE 2"x4" SPF @ 24" o.c. WITH A 2"x4" SPF VERTICAL POST TO THE TRUSS UNDER. AT EACH CROSS POINT, POSTS LONGER THAN 6' TO BE LATERALLY BRACED SO THAT THE DISTANCE BETWEEN END POINTS & BETWEEN ROWS OF BRACING DOES NOT EXCEED 6'.

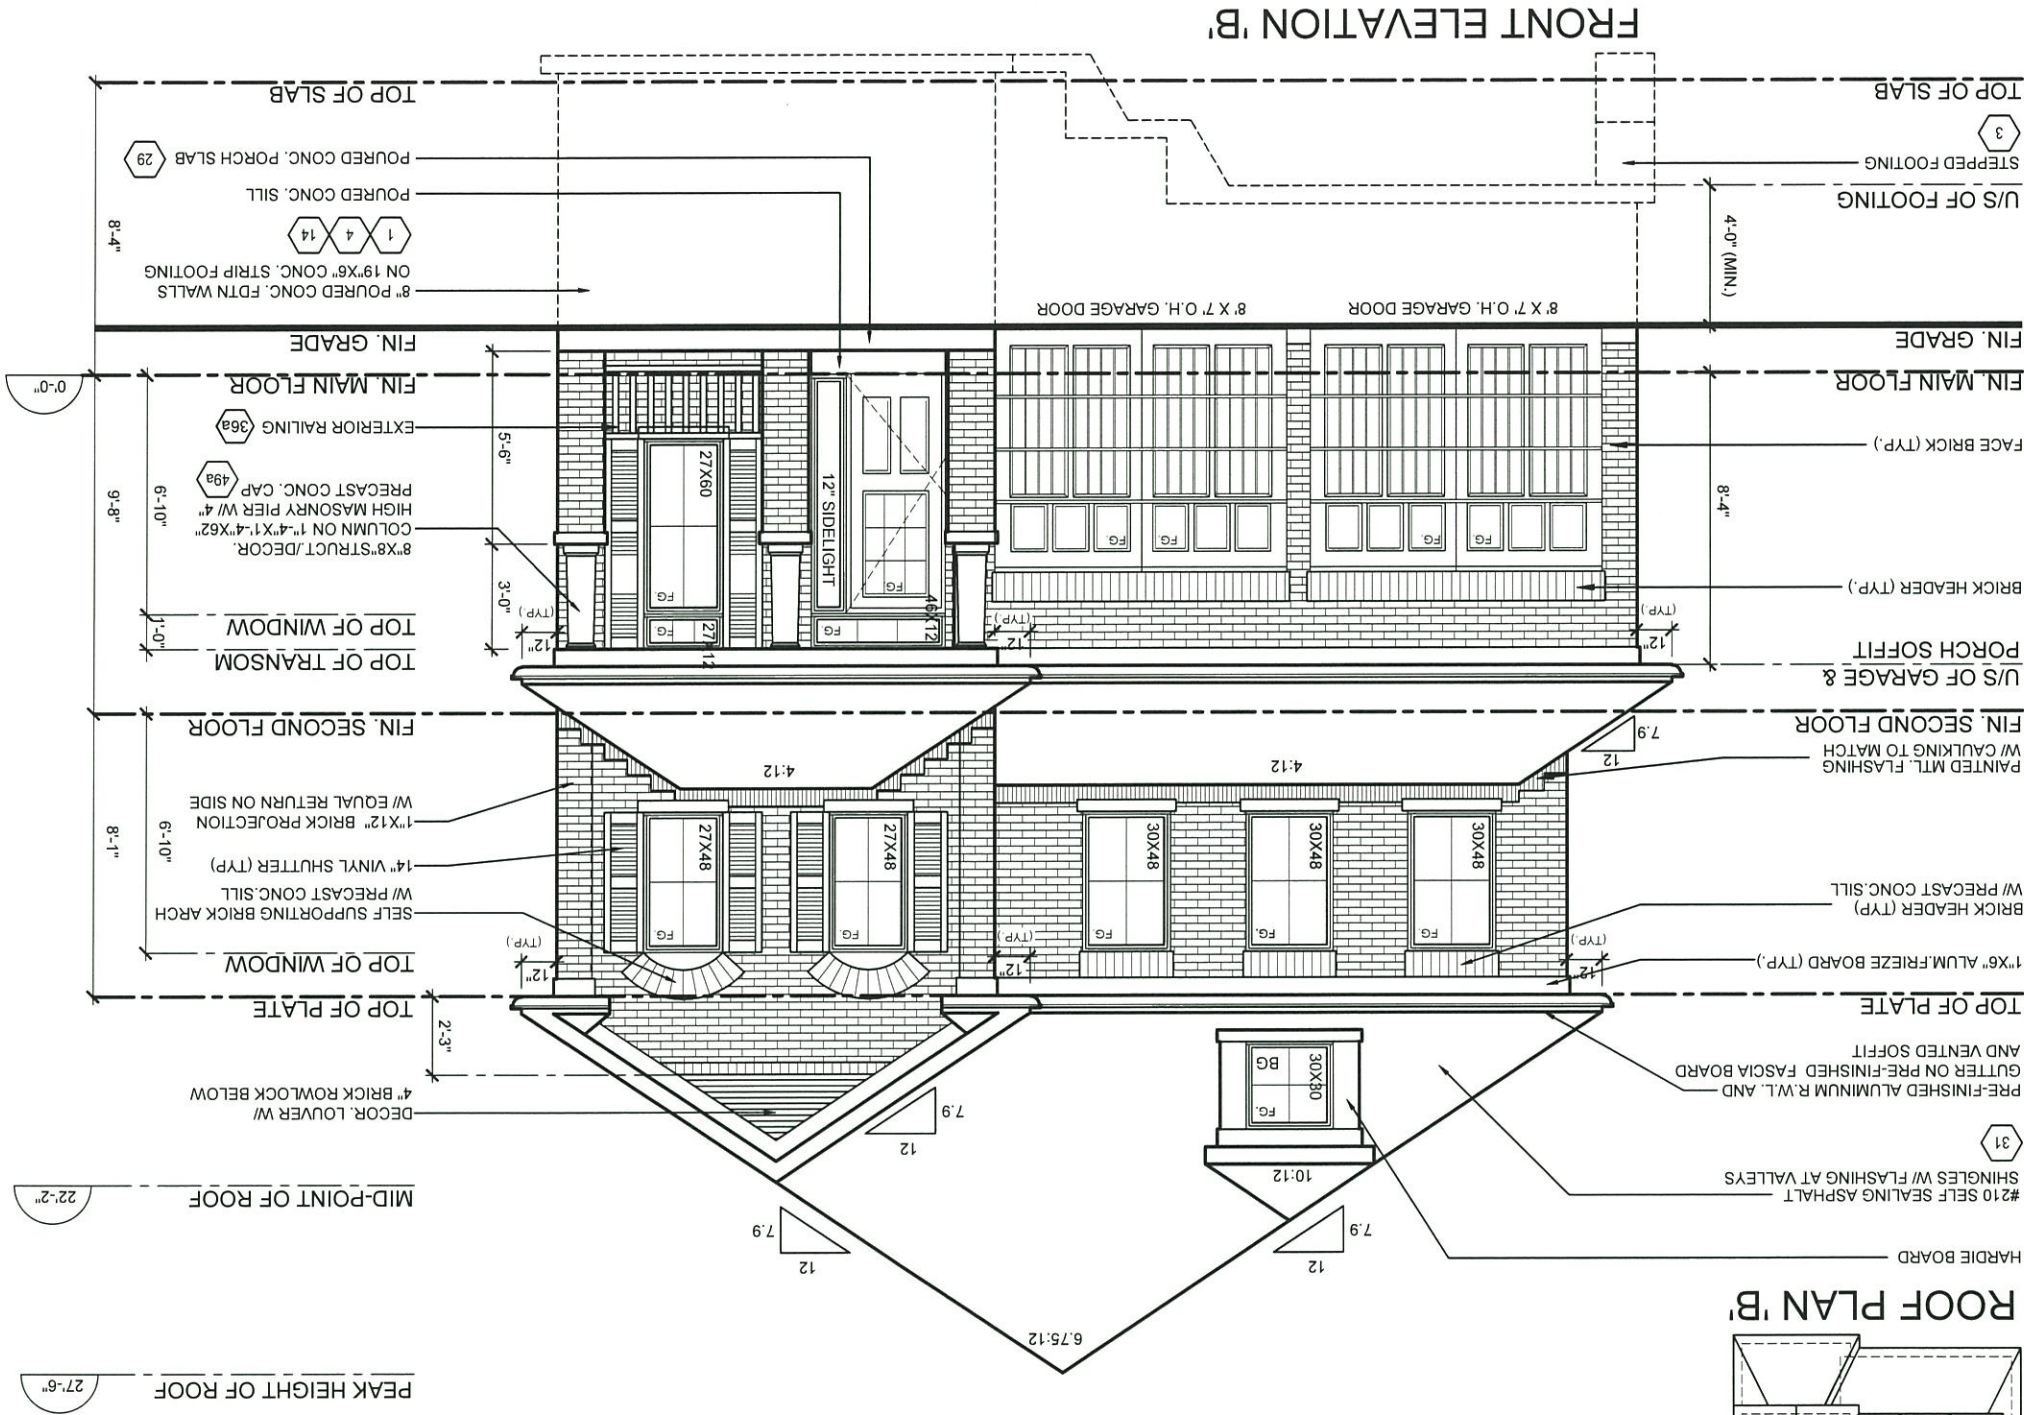

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for any errors or omissions in the drawings or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.



RN design
Imagine - Inspire - Create
TEL: (905) 738-3177
FAX: (905) 738-5449

ESQUIRE HOMES NORTHGLEN - PHASE 2 CLARINGTON, ONTARIO

MODEL

37-4 (FOUNDRY)

CLIENT

No. ISSUED OR REVISION COMMENTS
1. UPDATED TO OBC 2012 - 2015 ENACTMENT

DATE

DWN

CHK

SCALE
3/16" = 1'0"

PROJECT NUMBER
14093


PAGE

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.

I HEREBY CERTIFY THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN WORK SUBMITTED UNDER DIVISION C, PART 3, SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSIFICATION CODES.

QUALIFIED DESIGNER BCIN: 21032
FIRM BCIN: 26995
DATE: OCTOBER 19, 2015

SIGNATURE:

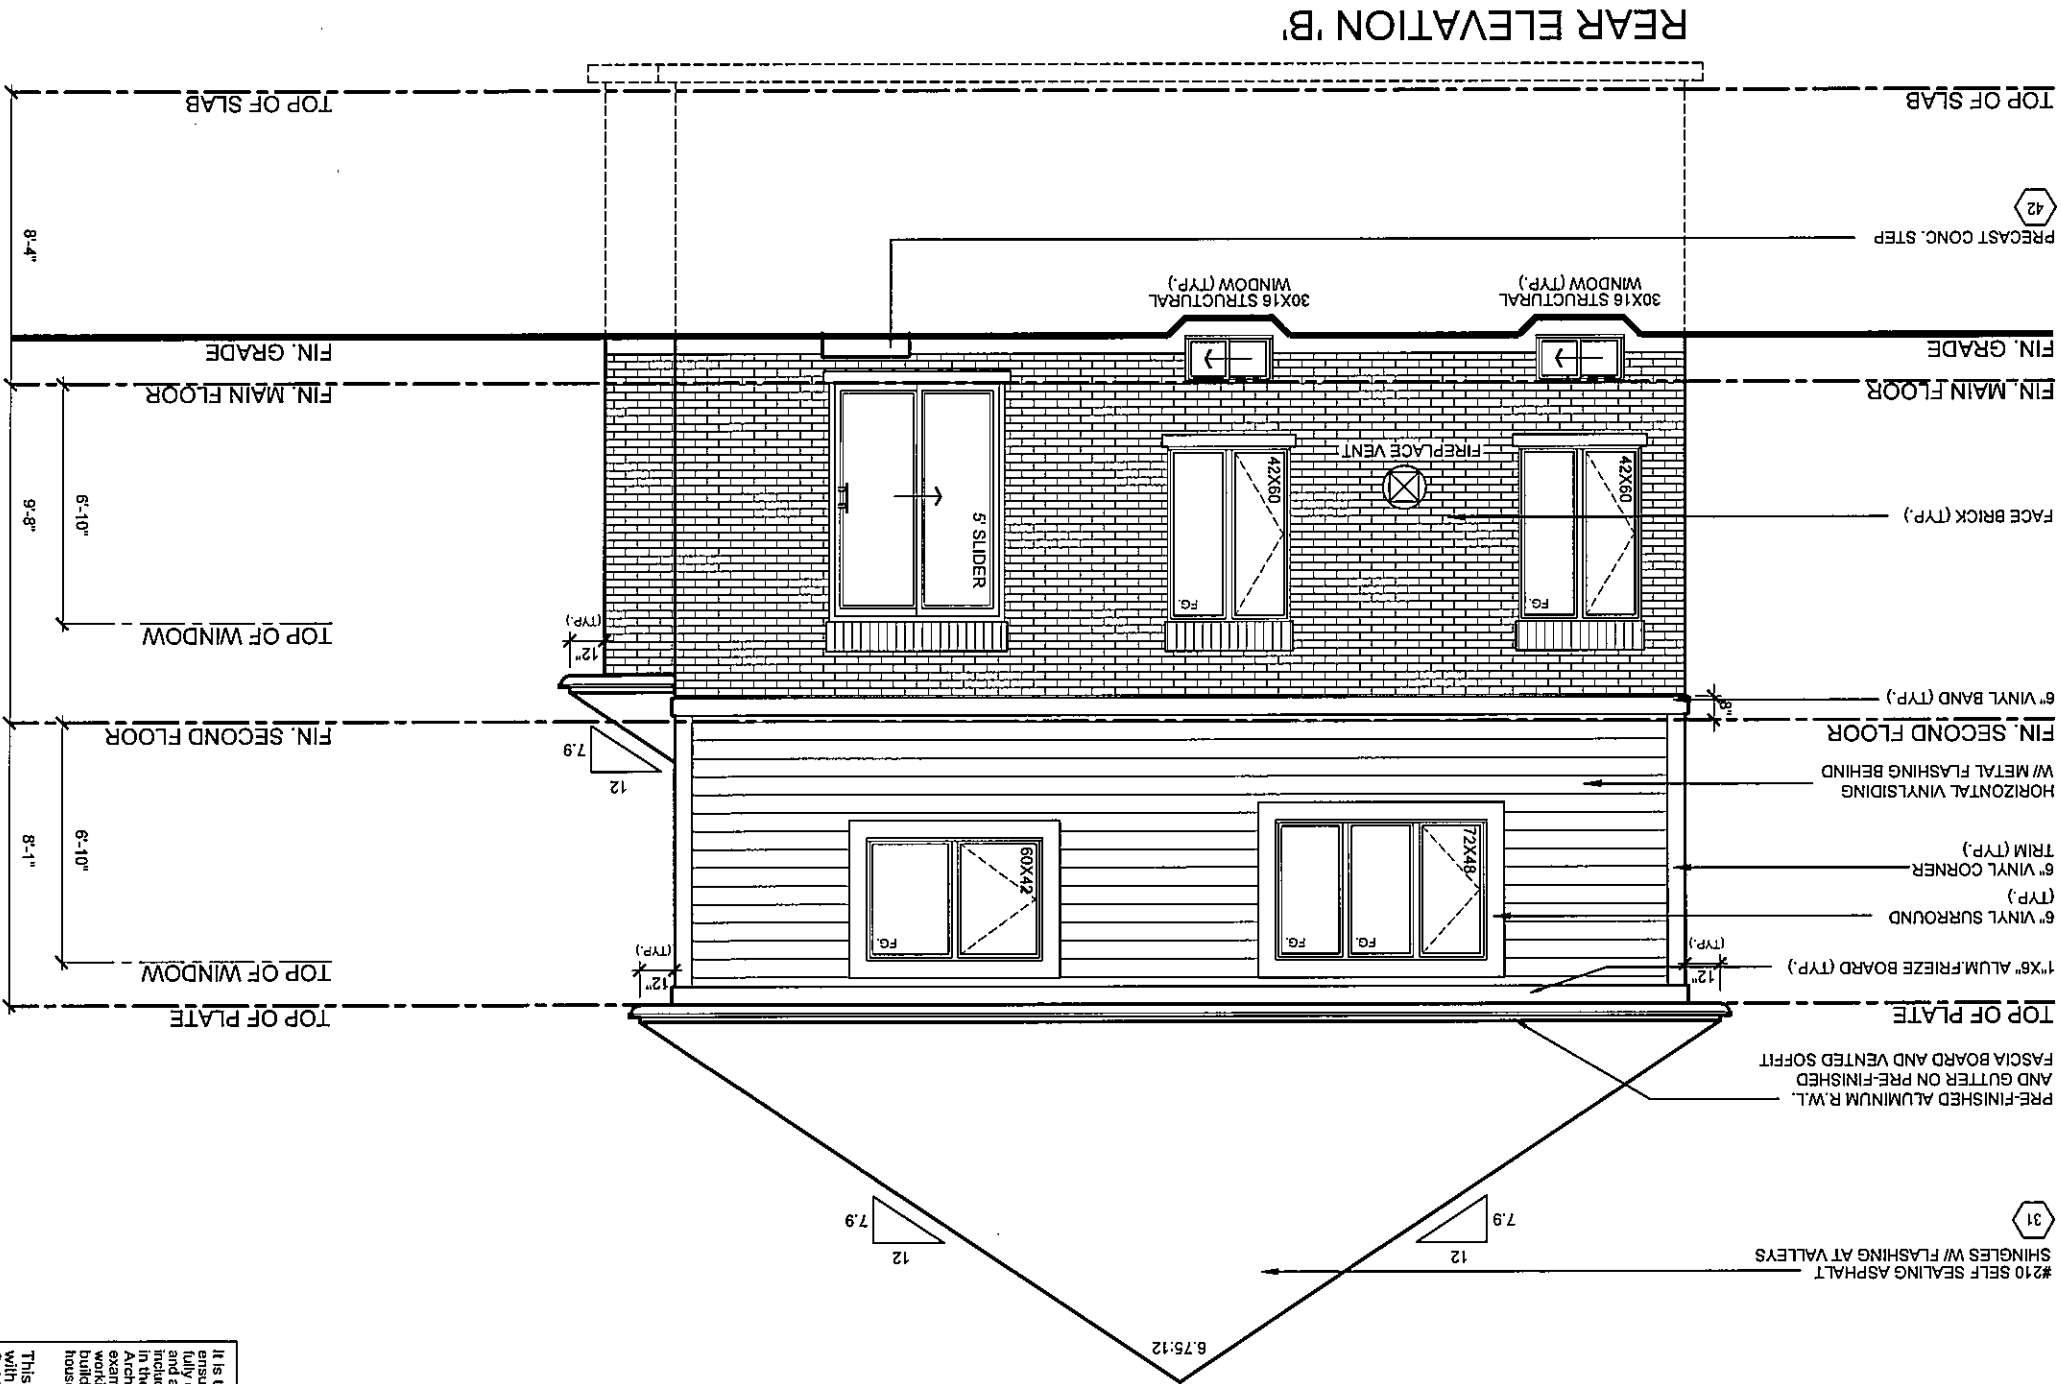

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for working drawings or approved plans or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.



RN design
Imagine • Inspire • Create
TEL: (905) 738-3177
FAX: (905) 738-6449

MODEL
37-4 (FOUNDRY)

CLIENT

ESQUIRE HOMES
NORTHGLEN - PHASE 2
CLARINGTON, ONTARIO

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.
REVISED JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J

I, DESIGNER, DESIGNER, I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THESE DRAWINGS. I AM A REGISTERED PROFESSIONAL ARCHITECT UNDER DIVISION C, PART 3, SUBSECTION 32.4, OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORIES.

QUALIFIED DESIGNER BCIN: 21032
FIRM BCIN: 26995
DATE: OCTOBER 19, 2015

SIGNATURE:

No.	ISSUED OR REVISION COMMENTS	DATE	DWN	CHK
1.	UPDATED TO OSC 2012 - 2015 ENACTMENT	OCT. 19/15	-	NC

SCALE
3/16" = 1'0"

PROJECT NUMBER
14093

PAGE

A12

CONSTRUCTION NOTES:

COMPLIANCE PACKAGE J - O.B.C. 2012 - 2015 ENACTMENT

(UNLESS OTHERWISE NOTED)
-ALL CONSTRUCTION TO CONFORM TO THE ONTARIO BUILDING CODE (O.B.C.) AND ALL OTHER CODES AND LOCAL AUTHORITIES HAVING JURISDICTION.
-ALL DIMENSIONS GIVEN FIRST IN IMPERIAL FOLLOWED BY METRIC.
-THERMAL RESISTANCE VALUES BASED ON ZONE 1

FOOTINGS / SLABS:

TYPICAL STRIP FOOTING:

O.B.C. 9.15.3.
-BASED ON 16"-114.9mm MAX. SUPPORTED JOIST LENGTH
-MIN. 2200psi (15MPa) CONCRETE AFTER 28 DAYS
-SHALL REST ON UNDISTURBED SOIL, ROCK OR COMPACTED GRANULAR FILL W/ MIN. 10.0psi (75KPa) BEARING CAPACITY
-FTG. SIZES MAY BE REDUCED FOR SOILS W/ GREATER BEARING CAPACITY (AS PER SOIL ENGINEERING REPORT)

TYPICAL STRIP FOOTING: (EXTERIOR WALLS)

O.B.C. 9.15.3.5.
-FTG. TO EXTEND MIN. 4'-0" (1200mm) BELOW GRADE
-1-STOREY - 13" X 4" (330mm X 100mm)
-2-STOREY - 19" X 6" (483mm X 155mm)
-3-STOREY - 26" X 8" (660mm X 203mm)

TYPICAL STRIP FOOTING: (INTERIOR BEARING WALLS)

O.B.C. 9.15.3.6.
-1-STOREY MASONRY - 16" X 4" (410mm X 100mm)
-1-STOREY STUD - 12" X 4" (305mm X 100mm)
-2-STOREY MASONRY - 26" X 8" (660mm X 203mm)
-18" X 5" (450mm X 130mm)
-3-STOREY MASONRY - 36" X 14" (900mm X 360mm)
-3-STOREY STUD - 24" X 8" (600mm X 200mm)

STEP FOOTING:

O.B.C. 9.15.3.9.
-23.5/8" (600mm) MAX. VERTICAL RISE & 23.5/8" (600mm) MIN. HORIZONTAL RUN.

DRAINAGE TILE OR PIPE:

O.B.C. 9.14.3.
-4" (100mm) MIN. DIA. Laid ON UNDISTURBED OR WELL COMPACTED SOIL W/ TOP OF TILE OR PIPE TO BE BELOW BOTTOM OF F.R. SLAB
-COVER TOP & SIDES OF TILE OR PIPE W/ 5/7/8" (150mm) OF CRUSHED STONE OR OTHER COURSE CLEAN GRANULAR MATERIAL.
-TILE SHALL DRAIN TO A SEWER, DRAINAGE DITCH, OR DRY WELL.

BASEMENT SLAB:

O.B.C. 9.13.1 & 9.14.
-3" (75mm) CONCRETE SLAB
-2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.16.4.5.
-DAMP-PROOF BELOW SLAB W/ MIN. 0.006" (0.15mm) POLYETHYLENE OR TYPE 'S' ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS.
-DAMP-PROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi(25MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS
-4" (100mm) OF COURSE GRANULAR MATERIAL
-PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG.
-WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO O.B.C. 9.13.3.
-FLOOR DRAIN PER O.B.C. 9.31.4.4.
-R10 RSI (1.76) INSULATION AT PERIMETER OF SLAB WHERE GRADE IS WITHIN 23"-1/2" (600mm) OF BASEMENT SLAB EDGE. INSULATION TO EXTEND TO NOT LESS THAN 23"-1/2" (600mm) BELOW EXTERIOR GRADE LEVEL (O.B.C. 9.8-12-2, 2.1.1.6 (5))
-UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFIRM TO SUPPLEMENTARY STANDARD (O.B.C. 9.8-9)

SLAB ON GROUND:

-3" (75mm) CONCRETE SLAB - O.B.C. 9.16.4.3.
-2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.16.4.5.
-DAMP-PROOF BELOW SLAB W/ MIN. 0.006" (0.15mm) POLYETHYLENE OR TYPE 'S' ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS.
-DAMP-PROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi(25MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS
-R10 RSI (1.76) INSULATION UNDER ENTIRE SLAB WHERE THE ENTIRE SLAB IS WITHIN 23"-1/2" (600mm) OF GRADE.
-4" (100mm) OF COURSE GRANULAR MATERIAL
-PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG.
-WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO O.B.C. 9.13.3.
-FLOOR DRAIN PER O.B.C. 9.31.4.4.
-UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFIRM TO SUPPLEMENTARY STANDARD (O.B.C. 9.8-9)

GARAGE SLAB / EXTERIOR SLAB:

-4" (100mm) CONCRETE SLAB
-4650psi (32MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS FOR UNREINFORCED CONC. & W/ 56% AIR ENTRAINMENT - O.B.C. 9.3.1.6.
-6" X 6" (W2.9 X W 2.9) WIRE MESH LOCATED NEAR MID-DEPTH OF SLAB
-4" (100mm) OF COURSE GRANULAR MATERIAL
-ANY FILL PLACED UNDER SLAB, OTHER THAN COURSE CLEAN GRANULAR MATERIAL, SHALL BE COMPACTED.

PLASTER:

O.B.C. 9.15.5.3.
-CONCRETE NB - 4" X 1/2" (100mm X 300mm)
-BLOCK NB - 4" X 1/2" (100mm X 300mm) BOUNDED & TIED TO WALL AS PER O.B.C. 9.20.1.1.2. TOP 7/7/8" (200mm) SOLID.
OR
-BEAM POCKET
-4" (100mm) INTO FDN. WALL W/ WIDTH TO MATCH BEAM SIZE
-1/12" (13mm) SPACE AROUND WOOD BEAMS (O.B.C. 9.23.2.2)

STILES BASED ON COLUMN SUPPORTING BEAMS CARRYING LOADS FROM NOT MORE THAN 2 WOOD FRAME FLOORS, WHERE THE LENGTHS OF JOISTS CARRIED BY SUCH BEAMS DO NOT EXCEED 16'-1" (4.9m) AND THE LIVE LOAD ON ANY FLOOR DOES NOT EXCEED 50psf (2.4KPa).

STEEL PIPE COLUMN:

O.B.C. 9.15.3.4. & 9.17.3.

-FIXED COLUMN
-MIN. 3 1/2" (90mm) DIA. W/ 3/16" (4.76mm) WALL THICKNESS
-FOR STEEL BEAMS, CLIPS @ TOP & MIN. 6" X 4" X 1/4" (152mm X 100mm X 6.35mm) STEEL BTM. PLATE
-FOR WOOD BEAMS, MIN. 4"X4"X1/4" (100mm X 100mm X 6.35mm) STEEL TOP & BTM. PLATES, OR TOP PLATE TO EXTEND MIN. 100mm OF BEAM
-ADJUSTABLE COLUMNS TO CONFORM TO CAN/CSG-7.2M4-WHERE IMPROVED LOAD DOES NOT EXCEED 36 KPa (O.B.C. 9.17.3.4)
COL. SPACING:
2 STOREY
-MAX. 9'-10" (2997mm)
-MAX. 16'-0" (4880mm)
-MAX. 16'-0" (4880mm)
3 STOREY
-MAX. 9'-10" (2997mm)
-MAX. 16'-0" (4880mm)
-MAX. 16'-0" (4880mm)
-WHERE COL. SITS ON FDN. WALL, USE 4" X 8" X 5/8" (100mm X 200mm X 16mm) STEEL PLATE WITH 2-5/8" (16mm) ANCHOR BOLTS

WOOD COLUMN:

O.B.C. 9.17.4.1.
-5-1/2" X 5-1/2" (140mm X 140mm) SOLID WOOD COLUMN.
-METAL SHOE ANCHORED TO FOOTING
-25" X 25" X 1/2" (640mm X 640mm X 300mm) CONC. PAD (1 FLOOR
-34" X 34" X 1/4" (864mm X 864mm X 360mm) CONC. PAD (2 FLOORS
SUPPORTED W/ 9'-10" COL. SPACING)

BLOCK PARTY WALL BEAM END BEARING: (WOOD BEAM / GIRDER TRUSSES)

-2"x8"x12" LEDGER BOARD FASTENED W/ 2/1 1/2" ANCHOR BOLTS @ 4" O.C.
-WHERE WOOD BEAMS BEAR ON FIREWALLS USE GENERAL NOTE 11
WHERE REQUIRED TO ORIGIN 5" SEPARATION DISTANCE
BETWEEN ADJACENT BEAMS
-12"x11"x 5/8" STL. PLATE ON TOP OF SOLID CONCRETE BLOCK WITH
2 - 1/2" Ø 3/8" ANCHOR BOLTS.

WALL ASSEMBLIES:

FOUNDATION WALL:

O.B.C. 9.15.4.2.
-FOR WALLS NOT EXCEEDING 9'-10" (3000mm) IN LATERALLY SUPPORTED HEIGHT.
-10" (250mm) SOLID 2200psi (15MPa) CONCRETE
-MAX. UNSUPPORTED HEIGHT OF 3'-11" (1200mm) & MAX. SUPPORTED HEIGHT OF 7'-0" (2100mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR.
-FOR WALLS NOT EXCEEDING 9'-0" (2700mm) IN LATERALLY SUPPORTED HEIGHT.
-10" (250mm) SOLID 2200psi (15MPa) CONCRETE
-MAX. UNSUPPORTED HEIGHT OF 4'-7" (1400mm) & MAX. SUPPORTED HEIGHT OF 8'-6" (2600mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR.
-LATERAL SUPPORT PROVIDED BY ANCHORED SILL PLATE TO JOISTS.
-FOR CONDITIONS EXCEEDING THESE MAXIMUMS AN ALTERNATIVE IN CONFORMANCE TO O.B.C. -19.15.4.1 SHALL BE USED OR IT SHALL BE DESIGNED UNDER O.B.C. -PART 4
-WALL SHALL EXTEND A MIN. 5 7/8" (150mm) ABOVE GRADE
-INSULATE W/ R12 (RSI 2.11) FROM UNDERSIDE OF SUBFLOOR TO NOT MORE THAN 8" (200mm) ABOVE FINISHED FLOOR OF BASEMENT (ZONE 1, O.B.C. 12.1.1.2.A)
-BACK FILL W/ NON-FROST SUSCEPTIBLE SOIL
REDUCTION OF THICKNESS:
O.B.C. 9.15.4.7.
-WHERE THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO ALLOW MASONRY FACING, THE MIN. REDUCED THICKNESS SHALL NOT BE LESS THAN 3-1/2" (90mm) THICK.
-TIE TO FACING MATERIAL WITH METAL TIES SPACED MAX. @ 7/7/8" (200mm) VERTICALLY O.C. & 2'-1" (600mm) HORIZONTALLY
-FILL SPACE BETWEEN WALL AND FACING SOLID W/ MORTAR
-WHERE WALL IS REDUCED FOR JOISTS, THE REDUCED THICKNESS SHALL BE MAX. 13-3/4" (350mm) HIGH & MIN. 3-1/2" (90mm) THICK
DAMP-PROOFING & WATERPROOFING:
-DAMP-PROOF THE EXTERIOR FACE OF WALL BELOW GRADE AS PER O.B.C. 9.13.2.
-WHERE INSULATION EXTENDS TO MORE THAN 4'-7" (1450mm) BELOW GRADE, A FDN. WALL DRAINAGE LAYER SHALL BE PROVIDED IN CONFORMANCE TO O.B.C. 9.14.2.1.2 (3) (4)
-FINISHED BASEMENTS SHALL HAVE INTERIOR DAMP-PROOFING EXTENDING FROM SLAB TO GRADE LEVEL & SHALL CONFORM TO O.B.C. 9.13.3.3 (3)
-WHERE HYDROSTATIC PRESSURE OCCURS, FDN. WALLS SHALL BE WATERPROOFED AS PER O.B.C. 9.13.3.
-WALLS THAT ARE WATERPROOFED DO NOT REQUIRE DAMP-PROOFING.

FOUNDATION WALLS @ UNSUPPORTED OPENINGS:

-2-20M BARS IN TOP PORTION OF WALL (UP TO 8'-0" OPENING)
-3-20M BARS IN TOP PORTION OF WALL (8'-0" TO 10'-0" OPENING)
-4-20M BARS IN TOP PORTION OF WALL (10'-0" TO 15'-0" OPENING)
-BARS STACKED VERTICALLY AT INTERIOR FACE OF WALL
-BARS TO HAVE MIN. 2" (50mm) CONCRETE COVER
-BARS TO EXTEND 2'-0" (600mm) BEYOND BOTH SIDES OF OPENING.


FRAME WALL CONSTRUCTION:

O.B.C. 9.23.
-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7/7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4 & 9.27.1)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.1.6.
-2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C.
-MIN. R22 (RSI 3.87) INSULATION (ZONE 1, O.B.C. 12.1.1.2.A)
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3 & 9.25.4.
-1/12" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):
O.B.C. 9.8-3. WALL = EW1b (SIC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE THE FOLLOWING MATERIALS:
-REPLACE R22 (RSI 3.87) INSULATION WITH R22 (RSI 3.87) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 4.8 kg/ sq.m.
-REPLACE 1/2" (12.7mm) INTERIOR GYPSUM BOARD WITH 1/2" (12.7mm) TYPE 'X' GYPSUM BOARD.

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE):
REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
-NON-COMBUSTIBLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURERS SPECIFICATIONS).
OR
-VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5 (3). OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING WHICH REPLACES EXTERIOR PLYWOOD OR EQUIV.

ALTERNATE FRAME WALL CONSTRUCTION:

O.B.C. 9.23.
-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7/7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4 & 9.27.1)
-1-1/2" (38mm) R8 (RSI 1.41) RIGID INSULATION W/ TAPED JOINTS (O.B.C. 9.27.3.4)
-BRACE W/ CONT. 1/6 GAUGE STEEL 'T' BRACES FROM TOP PLATE TO BTM. PLATE FOR THE FULL LENGTH OF WALL, OR CONT. 2" X 4" (38mm X 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO BTM. PLATE FOR FULL LENGTH OF WALL.
-2" X 4" (38mm X 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C. ON BOTTOM FLR. WHEN 3 STOREYS
-R14 (RSI 2.46) INSULATION (ZONE 1, O.B.C. 12.1.1.2.A)
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3 & 9.25.4.
-1/12" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):
O.B.C. 9.8-3. WALL = EW1b (SIC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.1.6, BETWEEN RIGID INSULATION AND WOOD STUD.
-REPLACE R14 (RSI 2.46) INSULATION WITH R14 (RSI 2.46) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 2.8 kg/ sq.m.
-REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

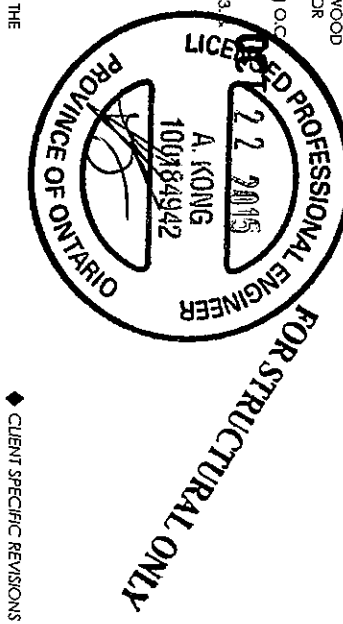

CLIENT SPECIFIC REVISIONS

THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD

MODEL	CLIENT	NO.	ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE
37-4 (FOUNDRY)	ESQUIRE HOMES NORTHGLEN - PHASE 2 CLARINGTON, ONTARIO	1.	ISSUED UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	-	NC	N/A
							PROJECT NUMBER 14093
							PAGE D1

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3, SUBSECTION 32.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

2. QUALIFIED DESIGNER BCIN: 21032
28995

3. SIGNATURE:

REVISIONS

1. DESIGN CHINA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THIS DRAWING. I AM A REGISTERED

- 17** **INTERIOR STUD WALLS:**
O.B.C. 1.9,23.10.1.
-2" x 4" (38mm x 89mm) WOOD STUDS @ 16" (400mm) O.C. OR
-2" x 6" (38mm x 140mm) WOOD STUDS @ 16" (400mm) O.C. W/
-DOUBLE 2" x 4" OR 2" x 6" TOP PLATES AND SINGLE BOTTOM PLATE
-1/2" (12.7mm) GYPSUM BOARD BOTH SIDES.
- 18** **BEARING STUD WALL (BASEMENT):**
-2" x 4" (38mm x 89mm) WOOD STUDS @ 16" (400mm) O.C. OR
-2" x 6" (38mm x 140mm) WOOD STUDS @ 16" (400mm) O.C. W/
-DBL. 2" x 4" OR 2" x 6" TOP PLATE.
-2" x 4" OR 2" x 6" BOTTOM PLATE ON DAMPROOING MATERIAL.
-1/2" (12.7mm) GYPSUM BOARD BOTH SIDES.
-1/2" (12.7mm) DIA. ANCHOR BOLTS @ 7'-10" (2400mm) O.C.
-FOOTING AS PER GENERAL NOTE #2 W/ 4" CONC. CURB
- 19** **PARTY WALL - BLOCK:**
O.B.C. SB-3 WALL = B66 (STC = 57, FIRE = 2 HR)
-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF FOOTINGS
TO THE U/S OF ROOF DECK
-SPACE BETWEEN TOP OF WALL & ROOF DECK SHALL BE TIGHTLY FILLED W/
MINERAL WOOL OR NONCOMBUSTIBLE MATERIAL & CAULKED TO PREVENT
SMOKE PASSAGE
-1/2" (12.7mm) GYPSUM BOARD W/ TAPE JOINTS BOTH SIDES
-2" x 2" (38mm x 38mm) WOOD STRAPPING @ 24" (600mm) O.C. BOTH
SIDES
-ABSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF 90% OF THE
CAVITY.
-7 1/2" (190mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE)
-STAGGER JOISTS & BEAMS MIN. 3 1/2" (90mm) @ PARTY WALLS AS PER
O.B.C. 9.10.9.1(1) & TABLE 2.1.1. SB-2
-ACUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE (2) TO TABLE 1)
PARTY WALL - BLOCK (AGAINST GARAGE):
O.B.C. SB-3 WALL = B56 (STC = 51, FIRE = 2 HR)
-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS
-1/2" (12.7mm) GYPSUM BOARD
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.-9.25.3
& 9.25.4.
-2" x 4" (38mm x 89mm) WOOD STRAPPING @ 16" (400mm) O.C.
-R20 (RSI 3.52) RIGID INSULATION
-7 1/2" (190mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE)
-1/2" (12.7mm) GYPSUM BOARD @ WALL & U/S OF CEILING BETWEEN
HOUSE AND GARAGE
-TAPE AND SEAL ALL JOINTS GAS TIGHT
REQ. INSULATION VALUES:
INSULATION VALUES PROVIDED BY CAN/CSA-F280-M90
RIGID INSULATION = 20.00
-LOW DENSITY CONCRETE BLOCK = 1.70
-WOOD FRAME W/ GYPSUM = 2.72
-AIR FILM - MOVING = 0.68
-AIR FILM - STILL = 0.17
TOTAL R^{si} VALUE = 25.27
- 19b** **FIREWALL:**
O.B.C. 9.10.1.1. & 3.1.10. & SB-3 WALL = B66 (STC = 57, FIRE = 2 HR)
-ONE FIREWALL IS REQUIRED FOR EVERY 6460 S.F. (600 SQ.M) OF BUILDING
AREA. O.B.C. 1.3,2,2.4.7.
-1/2" (12.7mm) GYPSUM BOARD W/ TAPE JOINTS
-2" x 2" (38mm x 38mm) WOOD STRAPPING @ 24" (600mm) O.C. ON BOTH SIDES
OF WALL
-SOUND ABSORPTIVE MATERIAL EACH SIDE FILLING 90% OF THE CAVITY
-7 1/2" (190mm) CONC. BLOCK MIN. 2 HR FIRE-RESISTANT RATING
-EVERY FIREWALL SHALL BE CONTINUOUS THROUGH ALL BUILDING STOREYS
-STAGGER JOISTS & BEAMS MIN. 5" (125mm) @ FIRE WALLS AS PER
O.B.C. 9.10.9.1(1) & TABLE 2.1.1. SB-2
-ACUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE (2) TO TABLE 1)
-PROTRUDE PAST FASCIA @ EAVES W/ BRICK CORBELLING
-EXTEND 5 7/8" (150mm) ABOVE ROOF SURFACES & HAVE ALUMINUM CAP W/
THROUGH WALL FLASHING PER O.B.C. 3.1.10.4.1(1)
-WHERE THE DIFFERENCE IN HEIGHT BETWEEN ADJACENT ROOFS IS GREATER
THAN 9'10" (3000mm), WALL NEED NOT EXTEND PAST UPPER ROOF SURFACE PER
O.B.C. 3.1.10.4.1(2)

- 240** **SUNKEN FINISHED AREA:**
-USE SOLID BUILT-UP WOOD BEARING POST TO SUPPORT SUNKEN AREA
AT FOUNDATION WALLS. EXTEND FOOTINGS TO SUPPORT POSTS.
-WHERE GRADING CONDITIONS WILL ALLOW, CHECK FOUNDATION
WALLS INSTEAD OF USING BEARING POSTS.
-FLOOR STRUCTURE AS PER NOTE # 28.
- 25** **DOUBLE MASONRY WYTHE WALL:**
O.B.C. 9.20.3.2.
-3 1/2" MASONRY VENEER ON 2" MORTAR JOINT ON 3 1/2" MASONRY VENEER
-WYTHES TO BE TIED W/ METAL TIES INSTALLED AS PER O.B.C. 9.20.9.4.
-SILL PLATE REQUIRED FOR ROOF AND CEILING FRAMING MEMBERS
-6" SILL W/ 2" BEARING ON EACH SIDE & ANCHOR BOLTS @ 4'-0" O.C.
NOTE: MASONRY TO BE SOLID & MORTAR JOINT FILLED SOLID FOR FLOOR
JOISTS BEARING ON WYTHES. FLOOR JOISTS ARE NOT TO PROJECT INTO CAVITY
AREA.
- 25b** **CORBEL MASONRY VENEER:**
-MASONRY VENEER TO BE CORBELLED AS PER O.B.C. 9.20.12.3.(1)
FLOOR ASSEMBLIES:
- 26** **SILL PLATE:**
O.B.C. 9.23.7.
-2" x 4" (38mm x 89mm) PLATE
-1/2" (12.7mm) DIA. ANCHOR BOLTS @ 7'-10" (2400mm) O.C. FASTENED TO
PLATE W/ NUTS AND WASHERS & SHALL BE EMBEDDED NOT LESS THAN 4"
(100mm) INTO FOUNDATION WALL.
-SILL PLATE TO BE CAULKED, OR PLACED ON A LAYER NOT LESS THAN 1"
(25mm) THICK BEFORE COMPRESSION, OR FOAM GASKET, OR PLACED
ON FULL BED OF MORTAR.
- 27** **BRIDGING & STRAPPING:**
O.B.C. 9.23.9.4.
a) STRAPPING
-1" x 3" (19mm x 64mm) NAILED TO U/S OF JOISTS @ MAX. 6'-11" (2100mm) O.C.
-FASTENED TO SILL OR HEADER @ ENDS
b) BRIDGING
-1" x 3" (19mm x 64mm) OR 2" x 2" (38mm x 38mm) CROSS BRIDGING @ MAX.
6'-11" (2100mm) O.C.
c) BRIDGING & STRAPPING
-a) & b) USED TOGETHER OR
-1 1/2" (38mm) SOLID BLOCKING @ MAX. 6'-11" (2100mm) O.C. USED WITH
STRAPPING (a)
d) FRAMING OR PANEL TYPE CEILING
-STRAPPING NOT REQUIRED IF FRAMING STRIPS OR PANEL TYPE CEILING FINISH
IS ATTACHED DIRECTLY TO JOISTS.
- 28** **FLOOR ASSEMBLY:**
O.B.C. 9.23.1.4.3. 9.23.1.4.4
-5/8" (15.9mm) WAFERBOARD (R-1 GRADE) OR EQUIVALENT
-FLOOR JOISTS AS PER FLOOR PLANS
- 29** **PORCH SLABS ABOVE COLD CELLAR:**
O.B.C. 9.39.1.4.
-REINFORCED CONCRETE SLABS ABOVE COLD CELLARS THAT ARE SUPPORTED
ON FOUNDATION WALLS NOT TO EXCEED 8'-2"
4-7/8" (125mm) 4650 psi (32 MPa) CONC. SLAB WITH 5 TO 8% AIR ENTRAINMENT
-REINFORCE WITH 10M BARS @ 7 7/8" (200mm) EACH WAY
-1 1/4" (30mm) CLEAR COVER FROM THE BOTTOM OF THE SLAB
-3" (75mm) END BEARING ON FOUNDATION WALL
-23 5/8" (600mm) x 23 5/8" (600mm) 10M DOWELS @ 23 5/8" (600mm) O.C.
- 30** **EXTERIOR BALCONY ASSEMBLY:**
-1 1/4" x 3 1/2" PRESSURE TREATED DECKING W/ 1/4" SPACING
-2"x4" WOOD PURLINS (CUT DIAGONALLY) @ 12" O.C. LAYING UNFASTENED
ON SINGLE PLY WATERPROOF ROOF MEMBRANE OR EQUIVALENT ON 5/8"
(15.9mm) EXTERIOR GRADE PLYWOOD SHEATHING ON 2"x4" WOOD PURLINS
(CUT DIAGONALLY) @ 12" O.C. DIRECTLY ON 2"x8" ROOF JOISTS @ 12" O.C.
(OR AS NOTED ON PLAN)
-EXTERIOR GUARD AS PER 356a
-SLOPE ASSEMBLY MINIMUM 2% TO ROOF SCUPPER
REQUIRED FOR OVER HEATED SPACES:
-ADD 2"x2" (38mm x 38mm) CROSS PURLINS @ 16" (400mm) O.C. FOR
VENTILATION OVER JOISTS (OBC 9.19.1.2. VENTING NOT LESS THAN 1/150 OF
CEILING AREA)
-ADD R31 (RSI 5.46) INSULATION BETWEEN JOISTS
-ADD CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3
& 9.25.4.
-ADD 1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR
-ADD 5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. 1.9.29.5.3.)

- 33** **CONVENTIONAL FRAMING:**
O.B.C. TABLE A6 OR A7
-2" x 6" (38mm x 140mm) RAFTERS @ 16" (400mm) O.C. MAX. SPAN 12'-9"
(3900mm)
-2"x4" (38mm x 89mm) COLLAR TIES AT MIDSPANS
-CEILING JOISTS TO BE 2" x 6" (38mm x 140mm) @ 16" (400mm) O.C.
UNLESS OTHERWISE NOTED.
-HIP & VALLEY RAFTERS TO BE MIN. 2" (50mm) LARGER THAN COMMON
RAFTERS & MIN. 1 1/2" (38mm) THICK.
- 34** **ATTIC ACCESS HATCH:**
O.B.C. 9.19.2.1.
-19 3/4" x 27 1/2" (500mm X 700mm) ATTIC HATCH WITH
WEATHERSTRIPPING & BACKED W/ R20 (RSI 3.52) INSULATION.
- 35** **GENERAL:**
PRIVATE STAIRS:
O.B.C. 9.8.4.
-MAX. RISE = 7-7/8" (200mm)
-MIN. RUN = 8-1/4" (210mm)
-MIN. TREAD = 9-1/4" (235mm)
-MAX. NOSING = 1" (25mm)
-MIN. HEADROOM = 6'-5" (1950mm)
-MIN. WIDTH = 2'-10" (640mm)
-MIN. WIDTH (BETWEEN WALL FACES) = 2'-11" (660mm)
-MIN. WIDTH (EXT STAIRS, BETWEEN GUARDS) = 2'-11" (660mm)
ANGLED TREADS:
-MIN. RUN = 5 7/8" (150mm)
-MIN. AVG. RUN = 7 7/8" (200mm)
-FINISHED RAILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS
-EXTERIOR CONC. STEPS TO HAVE MIN. 9 1/4" (235mm) TREAD &
MAX. 7 7/8" (200mm) RISE
-FOUND. WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2
-FIG. FOR FOUND. WALL TO BE MIN. 4'-0" (1200mm) BELOW GRADE
HANDRAILS:
O.B.C. 9.8.7
-ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm)
-TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3'-7" (1100mm)
-ONE HANDRAIL IS REQUIRED ON CURVED STAIRS OF ANY WIDTH WITHIN
DWELLING UNITS
-HANDRAILS ARE TO BE CONTINUOUS EXCEPT WHERE INTERRUPTED BY DOOR
WAYS, LANDINGS OR POSTS AT CHANGES IN DIRECTION
HEIGHT:
O.B.C. 9.8.7.4
-2'-10" (635mm) MIN. TO 3'-2" (965mm) MAX.
-3'-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS
-MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A
STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING
PROJECTIONS:
O.B.C. 9.8.7.6
-HANDRAILS AND PROJECTIONS BELOW HANDRAILS INCLUDING STEP
STRINGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED
WIDTH OF THE STAIR
- 35b** **PUBLIC STAIRS:**
O.B.C. 9.8.4.
-MAX. RISE = 7-3/32" (180mm)
-MIN. RUN = 11" (280mm)
-MIN. TREAD = 11" (280mm)
-MAX. NOSING = 1" (25mm)
-MIN. HEADROOM = 6'-9" (2050mm)
-MIN. WIDTH = 2'-11" (660mm)
-EXT STAIRS, BETWEEN GUARDS)
-FINISHED RAILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS
-FOUND. WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2
-FIG. FOR FOUND. WALL TO BE MIN. 4'-0" (1200mm) BELOW GRADE
HANDRAILS:
O.B.C. 9.8.7
-ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm)
-TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3'-7" (1100mm)
-TWO HANDRAILS ARE REQUIRED ON CURVED STAIRS OF ANY WIDTH
-HANDRAILS ARE TO BE CONTINUOUS INCLUDING AT LANDINGS EXCEPT
WHERE INTERRUPTED BY DOOR WAYS OR NEWEL POSTS AT CHANGES IN
DIRECTION
HEIGHT:
O.B.C. 9.8.7.4
-2'-10" (635mm) MIN. TO 3'-2" (965mm) MAX.
-3'-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS
-MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A
STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING
PROJECTIONS:
O.B.C. 9.8.7.6
-HANDRAILS AND PROJECTIONS BELOW HANDRAILS INCLUDING STEP
STRINGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED
WIDTH OF THE STAIR
- 36** **TERMINATION:**
O.B.C. 9.8.7.3
-ONE HAND RAIL SHALL EXTEND HORIZONTALLY NOT LESS THAN 11 3/4"
(300mm) BEYOND THE TOP & BOTTOM OF EACH STAIR AS
FINISH:
O.B.C. 9.8.9.6
-TREADS ARE TO BE WEAR AND SLIP RESISTANT, SMOOTH, EVEN AND FREE
FROM DEFECTS PER OBC 9.8.9.6.4(1)
-STAIRS AND RAMPS SHALL HAVE A COLOUR CONTRAST OR DISTINCTIVE
VISUAL PATTERN TO DEMARCATE THE LEADING EDGE OF THE TREADS,
LANDING AND THE BEGINNING AND END OF A RAMP.
- 36b** **INTERIOR GUARDS:**
O.B.C. SB-7 & 9.8.8.3.
-GUARDS TO BE 3'-6" (1070mm) HIGH
-FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2'-11" (900mm) HIGH
-INCLUDES WINDOWS OVER STAIRS, RAMPS AND LANDINGS
-PICKETS TO HAVE 4" (100mm) MAX. SPACING
-GUARDS FOR FLIGHTS OF STEPS (EXCEPT EXT STAIRS) TO BE 2'-11" (900mm) HIGH
- 36c** **EXTERIOR GUARDS:**
O.B.C. SB-7 & 9.8.8.3.
-GUARDS ARE REQUIRED WHEN WALKING SURFACE TO GRADE IS GREATER THAN
23 5/8" (600mm).
-FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2'-11" (900mm) HIGH
-FOR DWELLING UNITS GUARDS TO BE 3'-6" (1070mm) HIGH WHERE WALKING
SURFACE IS MORE THAN 3'-11" (1800mm) ABOVE ADJACENT GRADE.
-PICKETS TO HAVE 4" (100mm) MAX. SPACING
-GUARDS FOR FLIGHTS OF STEPS (EXCEPT EXT STAIRS) TO BE 2'-11" (900mm) HIGH
- THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE
VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK.
ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD

- 19b** **FIREWALL:**
O.B.C. 9.10.1.1. & 3.1.10. & SB-3 WALL = B66 (STC = 57, FIRE = 2 HR)
-ONE FIREWALL IS REQUIRED FOR EVERY 6460 S.F. (600 SQ.M) OF BUILDING
AREA. O.B.C. 1.3,2,2.4.7.
-1/2" (12.7mm) GYPSUM BOARD W/ TAPE JOINTS
-2" x 2" (38mm x 38mm) WOOD STRAPPING @ 24" (600mm) O.C. ON BOTH SIDES
OF WALL
-SOUND ABSORPTIVE MATERIAL EACH SIDE FILLING 90% OF THE CAVITY
-7 1/2" (190mm) CONC. BLOCK MIN. 2 HR FIRE-RESISTANT RATING
-EVERY FIREWALL SHALL BE CONTINUOUS THROUGH ALL BUILDING STOREYS
-STAGGER JOISTS & BEAMS MIN. 5" (125mm) @ FIRE WALLS AS PER
O.B.C. 9.10.9.1(1) & TABLE 2.1.1. SB-2
-ACUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE (2) TO TABLE 1)
-PROTRUDE PAST FASCIA @ EAVES W/ BRICK CORBELLING
-EXTEND 5 7/8" (150mm) ABOVE ROOF SURFACES & HAVE ALUMINUM CAP W/
THROUGH WALL FLASHING PER O.B.C. 3.1.10.4.1(1)
-WHERE THE DIFFERENCE IN HEIGHT BETWEEN ADJACENT ROOFS IS GREATER
THAN 9'10" (3000mm), WALL NEED NOT EXTEND PAST UPPER ROOF SURFACE PER
O.B.C. 3.1.10.4.1(2)
- 20** **PARTY WALL - FOUNDATION:**
O.B.C. 9.15.4.2.
-7 7/8" (200mm) SOLID CONC. FOUNDATION WALL @ 2200psi (15MPa)
COMPRESSIVE STRENGTH AFTER 28 DAYS
-FOUNDATION WALL TO REST ON FOOTING PER GENERAL NOTE #2
- 21** **PARTY WALL - WOOD STUD:**
O.B.C. SB-3 WALL = W13a (STC = 57, FIRE = 1 HR)
-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF
FOOTINGS TO THE U/S OF ROOF DECK
-2 ROWS 2"x4" (38mm x 89mm) STUDS @ 16" (400mm) O.C. W/ SEPARATE
2" x 4" (38mm x 89mm) BOTTOM PLATE & SEPARATE DOUBLE 2" x 4"
(38mm x 89mm) TOP PLATES
-SOUND ABSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF
90% OF THE CAVITY.
-5/8" (16mm) TYPE 'X' GYPSUM BOARD BOTH SIDES W/ JOINTS TAPE &
FILLED.
- 22** **GARAGE WALL & CEILING:**
O.B.C. 9.10.9.16.1(3)
-1/2" (12.7mm) GYPSUM BOARD ON BOTH SIDES OF STRUCTURAL ONLY
BETWEEN HOUSE AND GARAGE
-TAPE AND SEAL ALL JOINTS GAS TIGHT
-R22 (RSI 3.87) INSULATION IN WALLS.
-R31 (RSI 5.41) INSULATION IN CEILINGS W/ FLOOR ABOVE.
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3
& 9.25.4. FOR FLOOR ABOVE.
-INSULATION AROUND DUCTS AND PIPING NOT TO PROJECT INTO GARAGE
REQUIRED GARAGE AREA (REFER TO MUNICIPAL
-1/2" (12.7mm) GYPSUM BOARD
-ROOF FRAMING MEMBERS ARE FASTENED TO JOISTS WITH
4-3 1/4" (82mm) TOE NAILS
-BOTTOM PLATES ARE FASTENED TO FLOOR JOISTS BLOCKING
RIM JOIST WITH 3 1/4" (82mm) NAILS AT 7/8" (100mm) O.C. (100184942
WALLS ADJACENT TO ATTIC SPACE)
-1/2" (12.7mm) GYPSUM BOARD
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORM

- 31** **ROOF ASSEMBLIES**
TYPICAL ROOF:
O.B.C. 9.26.
-NO. 210 (30.56G/m2) ASPHALT SHINGLES
-FOR ROOFS BETWEEN 4:12 & 8:12 PITCH PROVIDE EAVES PROTECTION TO
EXTEND UP THE ROOF SLOPE MIN. 2'-11" (900mm) FROM EDGE TO A LINE NOT
LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTERIOR WALL.
-EAVES PROTECTION LAND BENEATH STARTER STRIP.
-EAVE PROTECTION NOT REQUIRED OVER UNHEATED SPACES.
-STARTER STRIP AS PER O.B.C. 9.26.7.2.
-AFTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.(3)
-1/2" (12.7mm) PLYWOOD SHEATHING OR OSB (O-2 GRADE) WITH "H" CLIPS
(38mm x 10mm) CROSS PURLINS @ 24" (600mm) O.C. (REFER TO MANUFACTURERS
RECOMMENDED WOOD TRUSSES @ 24" (600mm) O.C. (REFER TO MANUFACTURERS
LAYOUT)
-THUS BRACING AS PER TRUSS MANUFACTURER
-EAVES PROTECTION ON PREFINISHED FASCIA AND VENTED SOFFIT (VENT OR
ALUMINUM)
-ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH .50% AT SOFFIT.
CEILING:
-R20 (RSI 3.52) INSULATION
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.
& 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR
-5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. 1.9.29.5.3.)
- 32** **CEILING:**
-R20 (RSI 3.52) INSULATION
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.
& 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR
-5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. 1.9.29.5.3.)
- 33** **CONVENTIONAL FRAMING:**
O.B.C. TABLE A6 OR A7
-2" x 6" (38mm x 140mm) RAFTERS @ 16" (400mm) O.C. MAX. SPAN 12'-9"
(3900mm)
-2"x4" (38mm x 89mm) COLLAR TIES AT MIDSPANS
-CEILING JOISTS TO BE 2" x 6" (38mm x 140mm) @ 16" (400mm) O.C.
UNLESS OTHERWISE NOTED.
-HIP & VALLEY RAFTERS TO BE MIN. 2" (50mm) LARGER THAN COMMON
RAFTERS & MIN. 1 1/2" (38mm) THICK.
- 34** **ATTIC ACCESS HATCH:**
O.B.C. 9.19.2.1.
-19 3/4" x 27 1/2" (500mm X 700mm) ATTIC HATCH WITH
WEATHERSTRIPPING & BACKED W/ R20 (RSI 3.52) INSULATION.
- 35** **GENERAL:**
PRIVATE STAIRS:
O.B.C. 9.8.4.
-MAX. RISE = 7-7/8" (200mm)
-MIN. RUN = 8-1/4" (210mm)
-MIN. TREAD = 9-1/4" (235mm)
-MAX. NOSING = 1" (25mm)
-MIN. HEADROOM = 6'-5" (1950mm)
-MIN. WIDTH = 2'-10" (640mm)
-MIN. WIDTH (BETWEEN WALL FACES) = 2'-11" (660mm)
-MIN. WIDTH (EXT STAIRS, BETWEEN GUARDS) = 2'-11" (660mm)
ANGLED TREADS:
-MIN. RUN = 5 7/8" (150mm)
-MIN. AVG. RUN = 7 7/8" (200mm)
-FINISHED RAILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS
-EXTERIOR CONC. STEPS TO HAVE MIN. 9 1/4" (235mm) TREAD &
MAX. 7 7/8" (200mm) RISE
-FOUND. WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2
-FIG. FOR FOUND. WALL TO BE MIN. 4'-0" (1200mm) BELOW GRADE
HANDRAILS:
O.B.C. 9.8.7
-ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm)
-TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3'-7" (1100mm)
-ONE HANDRAIL IS REQUIRED ON CURVED STAIRS OF ANY WIDTH WITHIN
DWELLING UNITS
-HANDRAILS ARE TO BE CONTINUOUS EXCEPT WHERE INTERRUPTED BY DOOR
WAYS, LANDINGS OR POSTS AT CHANGES IN DIRECTION
HEIGHT:
O.B.C. 9.8.7.4
-2'-10" (635mm) MIN. TO 3'-2" (965mm) MAX.
-3'-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS
-MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A
STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING
PROJECTIONS:
O.B.C. 9.8.7.6
-HANDRAILS AND PROJECTIONS BELOW HANDRAILS INCLUDING STEP
STRINGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED
WIDTH OF THE STAIR
- 35b** **PUBLIC STAIRS:**
O.B.C. 9.8.4.
-MAX. RISE = 7-3/32" (180mm)
-MIN. RUN = 11" (280mm)
-MIN. TREAD = 11" (280mm)
-MAX. NOSING = 1" (25mm)
-MIN. HEADROOM = 6'-9" (2050mm)
-MIN. WIDTH = 2'-11" (660mm)
-EXT STAIRS, BETWEEN GUARDS)
-FINISHED RAILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS
-FOUND. WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2
-FIG. FOR FOUND. WALL TO BE MIN. 4'-0" (1200mm) BELOW GRADE
HANDRAILS:
O.B.C. 9.8.7
-ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm)
-TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3'-7" (1100mm)
-TWO HANDRAILS ARE REQUIRED ON CURVED STAIRS OF ANY WIDTH
-HANDRAILS ARE TO BE CONTINUOUS INCLUDING AT LANDINGS EXCEPT
WHERE INTERRUPTED BY DOOR WAYS OR NEWEL POSTS AT CHANGES IN
DIRECTION
HEIGHT:
O.B.C. 9.8.7.4
-2'-10" (635mm) MIN. TO 3'-2" (965mm) MAX.
-3'-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS
-MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A
STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING
PROJECTIONS:
O.B.C. 9.8.7.6
-HANDRAILS AND PROJECTIONS BELOW HANDRAILS INCLUDING STEP
STRINGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED
WIDTH OF THE STAIR
- 36** **TERMINATION:**
O.B.C. 9.8.7.3
-ONE HAND RAIL SHALL EXTEND HORIZONTALLY NOT LESS THAN 11 3/4"
(300mm) BEYOND THE TOP & BOTTOM OF EACH STAIR AS
FINISH:
O.B.C. 9.8.9.6
-TREADS ARE TO BE WEAR AND SLIP RESISTANT, SMOOTH, EVEN AND FREE
FROM DEFECTS PER OBC 9.8.9.6.4(1)
-STAIRS AND RAMPS SHALL HAVE A COLOUR CONTRAST OR DISTINCTIVE
VISUAL PATTERN TO DEMARCATE THE LEADING EDGE OF THE TREADS,
LANDING AND THE BEGINNING AND END OF A RAMP.
- 36b** **INTERIOR GUARDS:**
O.B.C. SB-7 & 9.8.8.3.
-GUARDS TO BE 3'-6" (1070mm) HIGH
-FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2'-11" (900mm) HIGH
-INCLUDES WINDOWS OVER STAIRS, RAMPS AND LANDINGS
-PICKETS TO HAVE 4" (100mm) MAX. SPACING
-GUARDS FOR FLIGHTS OF STEPS (EXCEPT EXT STAIRS) TO BE 2'-11" (900mm) HIGH
- 36c** **EXTERIOR GUARDS:**
O.B.C. SB-7 & 9.8.8.3.
-GUARDS ARE REQUIRED WHEN WALKING SURFACE TO GRADE IS GREATER THAN
23 5/8" (600mm).
-FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2'-11" (900mm) HIGH
-FOR DWELLING UNITS GUARDS TO BE 3'-6" (1070mm) HIGH WHERE WALKING
SURFACE IS MORE THAN 3'-11" (1800mm) ABOVE ADJACENT GRADE.
-PICKETS TO HAVE 4" (100mm) MAX. SPACING
-GUARDS FOR FLIGHTS OF STEPS (EXCEPT EXT STAIRS) TO BE 2'-11" (900mm) HIGH
- THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE
VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK.
ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD

- 22** **GARAGE WALL & CEILING:**
O.B.C. 9.10.9.16.1(3)
-1/2" (12.7mm) GYPSUM BOARD ON BOTH SIDES OF STRUCTURAL ONLY
BETWEEN HOUSE AND GARAGE
-TAPE AND SEAL ALL JOINTS GAS TIGHT
-R22 (RSI 3.87) INSULATION IN WALLS.
-R31 (RSI 5.41) INSULATION IN CEILINGS W/ FLOOR ABOVE.
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3
& 9.25.4. FOR FLOOR ABOVE.
-INSULATION AROUND DUCTS AND PIPING NOT TO PROJECT INTO GARAGE
REQUIRED GARAGE AREA (REFER TO MUNICIPAL
-1/2" (12.7mm) GYPSUM BOARD
-ROOF FRAMING MEMBERS ARE FASTENED TO JOISTS WITH
4-3 1/4" (82mm) TOE NAILS
-BOTTOM PLATES ARE FASTENED TO FLOOR JOISTS BLOCKING
RIM JOIST WITH 3 1/4" (82mm) NAILS AT 7/8" (100mm) O.C. (100184942
WALLS ADJACENT TO ATTIC SPACE)
-1/2" (12.7mm) GYPSUM BOARD
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORM
- 23** **DOUBLE VOLUME WALLS:**
O.B.C. 9.23.10.1.
-3/8" (9.5mm) PLYWOOD, OSB OR WATERBOARD SHEATHING
-REFER TO PLAN FOR STUD SPECIFICATION
-STUDS FASTENED AT TOP & BOTTOM WITH 3/32" (16mm) TOE NAILS
-DOUBLE TOP PLATES FASTENED TOGETHER WITH 3/8" (16mm) AT
7/8" (200mm) O.C.
-SOLID BRIDGING AT 3'-11" (1200mm) O.C.
-MIN. R22 (RSI 3.87) INSULATION (ZONE 1: O.B.C. 1.2.1.1.2.A.)
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE WITH O.B.C.
9.25.3. & 9.25.5.
- 24** **EXPOSED FLOOR:**
-FLOOR AS PER NOTE # 28
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/
O.B.C.-9.25.3. & 9.25.4
-R31 (RSI 5.46) INSULATION
-VENTED ALUMINUM SOFFIT

- 31** **ROOF ASSEMBLIES**
TYPICAL ROOF:
O.B.C. 9.26.
-NO. 210 (30.56G/m2) ASPHALT SHINGLES
-FOR ROOFS BETWEEN 4:12 & 8:12 PITCH PROVIDE EAVES PROTECTION TO
EXTEND UP THE ROOF SLOPE MIN. 2'-11" (900mm) FROM EDGE TO A LINE NOT
LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTERIOR WALL.
-EAVES PROTECTION LAND BENEATH STARTER STRIP.
-EAVE PROTECTION NOT REQUIRED OVER UNHEATED SPACES.
-STARTER STRIP AS PER O.B.C. 9.26.7.2.
-AFTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.(3)
-1/2" (12.7mm) PLYWOOD SHEATHING OR OSB (O-2 GRADE) WITH "H" CLIPS
(38mm x 10mm) CROSS PURLINS @ 24" (600mm) O.C. (REFER TO MANUFACTURERS
RECOMMENDED WOOD TRUSSES @ 24" (600mm) O.C. (REFER TO MANUFACTURERS
LAYOUT)
-THUS BRACING AS PER TRUSS MANUFACTURER
-EAVES PROTECTION ON PREFINISHED FASCIA AND VENTED SOFFIT (VENT OR
ALUMINUM)
-ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH .50% AT SOFFIT.
CEILING:
-R20 (RSI 3.52) INSULATION
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.
& 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR
-5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. 1.9.29.5.3.)
- 32** **CEILING:**
-R20 (RSI 3.52) INSULATION
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.
& 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR
-5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. 1.9.29.5.3.)
- 33** **CONVENTIONAL FRAMING:**
O.B.C. TABLE A6 OR A7
-2" x 6" (38mm x 140mm) RAFTERS @ 16" (400mm) O.C. MAX. SPAN 12'-9"
(3900mm)
-2"x4" (38mm x 89mm) COLLAR TIES AT MIDSPANS
-CEILING JOISTS TO BE 2" x 6" (38mm x 140mm) @ 16" (400mm) O.C.
UNLESS OTHERWISE NOTED.
-HIP & VALLEY RAFTERS TO BE MIN. 2" (50mm) LARGER THAN COMMON
RAFTERS & MIN. 1 1/2" (38mm) THICK.
- 34** **ATTIC ACCESS HATCH:**
O.B.C. 9.19.2.1.
-19 3/4" x 27 1/2" (500mm X 700mm) ATTIC HATCH WITH
WEATHERSTRIPPING & BACKED W/ R20 (RSI 3.52) INSULATION.
- 35** **GENERAL:**
PRIVATE STAIRS:
O.B.C. 9.8.4.
-MAX. RISE = 7-7/8" (200mm)
-MIN. RUN = 8-1/4" (210mm)
-MIN. TREAD = 9-1/4" (235mm)
-MAX. NOSING = 1" (25mm)
-MIN. HEADROOM = 6'-5" (1950mm)
-MIN. WIDTH = 2'-10" (640mm)
-MIN. WIDTH (BETWEEN WALL FACES) = 2'-11" (660mm)
-MIN. WIDTH (EXT STAIRS, BETWEEN GUARDS) = 2'-11" (660mm)
ANGLED TREADS:
-MIN. RUN = 5 7/8" (150mm)
-MIN. AVG. RUN = 7 7/8" (200mm)
-FINISHED RAILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS
-EXTERIOR CONC. STEPS TO HAVE MIN. 9 1/4" (235mm) TREAD &
MAX. 7 7/8" (200mm) RISE
-FOUND. WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2
-FIG. FOR FOUND. WALL TO BE MIN. 4'-0" (1200mm) BELOW GRADE
HANDRAILS:
O.B.C. 9.8.7
-ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm)
-TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3'-7" (1100mm)
-ONE HANDRAIL IS REQUIRED ON CURVED STAIRS OF ANY WIDTH WITHIN
DWELLING UNITS
-HANDRAILS ARE TO BE CONTINUOUS EXCEPT WHERE INTERRUPTED BY DOOR
WAYS, LANDINGS OR POSTS AT CHANGES IN DIRECTION
HEIGHT:
O.B.C. 9.8.7.4
-2'-10" (635mm) MIN. TO 3'-2" (965mm) MAX.
-3'-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS
-MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A
STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING
PROJECTIONS:
O.B.C. 9.8.7.6
-HANDRAILS AND PROJECTIONS BELOW HANDRAILS INCLUDING STEP
STRINGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED
WIDTH OF THE STAIR
- <

