(UNLESS OTHERWISE NOTED) ALL CONSTRUCTION TO CONFORM TO THE ONTARIO BUILDING CODE (O.B.C.) AND ALL OTHER CODES AND LOCAL AUTHORITIES ALL DIMENSIONS GIVEN FIRST IN IMPERIAL FOLLOWED BY METRIC. IERMAL RESISTANCE VALUES BASED ON ZONE I

FOOTINGS / SLABS: TYPICAL STRIP FOOTING:

-BASED ON 16'-1"(4.9m) MAX. SUPPORTED JOIST LENGTH -MIN. 2200psi (15MPa) CONCRETE AFTER 28 DAYS -SHALL REST ON UNDISTURBED SOIL, ROCK OR COMPACTED GRANULAR FILL W/ MIN. 10.9psi (75kPa) BEARING CAPACITY

FIG. 50 HAVE CONTINUOUS KEY

-FIG. SIZES MAY BE REDUCED FOR SOILS W/ GREATER BEARING CAPACITY

(AS PER SOILS ENGINEERING REPORT)

1 TYPICAL STRIP FOOTING: (EXTERIOR WALLS)
O.B.C. 9.15.3.5. -FTG. TO EXTEND MIN. 4'-0" (1200mm) BELOW GRADE -1 STOREY - 13" X 4" (330mm X 100mm) -2 STOREY - 19" X 6" (485mm X 155mm) -3 STOREY - 26" X 9" (660mm X 230mm)

-1 STOREY -10" X 4" (255mm X 100mm) -2 STOREY -14" X 4" (360mm X 100mm) -3 STOREY -18" X 5" (460mm X 130mm)

TYPICAL STRIP FOOTING: (INTERIOR BEARING WALLS) O.B.C. 9.15.3.6.

-1 STOREY MASONRY - 16" X 4" (410mm X 100mm) -1 STOREY STUD -18" X -1" (410mm X 100mm)
-1 STOREY STUD -12" X -1" (305mm X 100mm)
-2 STOREY MASONRY -26" X -26" X -20" (450mm X 230mm)
-3 STOREY MASONRY -36" X 14" (450mm X 130mm)
-3 STOREY MASONRY -18" X -24" X -24"

3 STEP FOOTING: O.B.C. 9.15.3.9.

-23 5/8" (600mm) MAX, VERTICAL RISE & 23 5/8" (600mm) MIN, HORIZONTAL DRAINAGE TILE OR PIPE:

O.B.C. 9.14.3. O.B.C. Y. 14.3.

-4" (100mm) MIN. DIA. LAID ON UNDISTURBED OR WELL COMPACTED SOIL
W/TOP OF TILE OR PIPE TO BE BELOW BOTTOM OF FUR. SLAB.

-COVER TOP & SIDES OF TILE OR PIPE W/ 5.7/8" (1.50mm) OF CRUSHED STONE OR OTHER COURSE CLEAN GRANULAR MATERIAL.
-TILE SHALL DRAIN TO A SEWER, DRAINAGE DITCH, OR DRY WELL.

5 BASEMENT SLAB: O.B.C. 9.13. & 9.16.

-3" (75mm) CONCRETE SLAB -2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.16.4.5. DAMPPROOF BELOW SLAB W/ MIN. 0.006" (0.15mm) POLYETHYLENE OR TYPE 'S' ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS.
-DAMPPROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi(25MPg) COMPRESSIVE STRENGTH AFTER 28 DAYS 4" (100mm) OF COURSE GRANULAR MATERIAL

\* (TOTAL)

\*\*PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG.

WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO O.B.C. 9.13.3. -FLOOR DRAIN PER O.B.C.9.31.4.4.

-R10 (RSI 1.76) INSULATION AT PERIMETER OF SLAB WHERE GRADE IS WITHIN 23-1/2" (600mm) OF BASEMENT SLAB EDGE. INSULATION TO EXTEND TO NO LESS THAN 23-1/2" (600mm) BELOW EXTERIOR GRADE LEVEL (O.B.C. SB-12 -

2.1.1.6 (5))
- UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM SOIL GAS CONTROL SHALL CONFIRM TO SUPPLEMENTAL NDARD (O.B.C. SB-9) SLAB ON GROUND:

3' (75mm) CONCRETE SLAB - O.B.C. 9.16.4.3. -2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.16.4.5.

-DAMPPROOF BELOW SLAB W/ MIN. 0.006" (0.15mm) POLYETHYLENE OR TYPE IS" ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS.

-DAMPPROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi(25MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS -R10 (RSI 1.76) INSULATION UNDER ENTIRE SLAB WHERE THE ENTIRE SLAB IS WITHIN 23-1/2" (600mm) OF GRADE. WIHMIN 23-1/2" (600mm) OF GRADE.
4" (100mm) OF COURSE GRANULAR MATERIAL
PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG.
WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO

O.B.C. 9, 13.3.

-FLOOR DRAIN PER O.B.C.9, 31, 4.4.
-UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE
A PROBLEM, SOIL GAS CONTROL SHALL CONFIRM TO SUPPLEMENTARY

TANDARD (O.B.C. \$8-9) 6 GARAGE SLAB / EXTERIOR SLAB:

-4"(100mm) CONCRETE SLAB
-4650psi (32MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS FOR
UNREINFORCED CONC. & W/ 5-8% AIR ENTRAINMENT - O.B.C. 9.3.1.6.
-6" X 6" (W2.9 X W 2.9) WIRE MESH LOCATED NEAR MID-DEPTH OF SLAB 4" (100mm) OF COURSE GRANULAR MATERIAL ANY FILL PLACED UNDER SLAB, OTHER THAN COURSE CLEAN GRANULAR MATERIAL, SHALL BE COMPACTED.

7 PILASTERS:

D.B.C. 9.15.5.3. PILASTER
--CONCRETE NIB - 4" X 12" (100mm X 300mm)
--BLOCK NIB - 4" X 12" (100mm X 300mm) BONDED & TIED TO WALL AS PER O.B.C. 9.20.11.2. TOP 7 7/8" (200mm) SOLID.

BEAM POCKET
4" (100mm) INTO FDN. WALL W/ WIDTH TO MATCH BEAM SIZE. 1/2" (13mm) SPACE AROUND WOOD BEAMS (O.B.C. 9.23.2.2.

STRUCTURAL COLUMNS -SIZES BASED ON COLUMN SUPPORTING BEAMS CARRYING LOADS FROM NOT MORE THAN 2 WOOD FRAME FLOORS, WHERE THE LENGTHS OF JOISTS CARRIED BY SUCH BEAMS DO NOT EXCEED 16'-1" (4.9m) AND THE LIVE LOAD ON ANY FLOOR DOES NOT EXCEED 50psf (2.4kPa).

8 STEEL PIPE COLUMN: O.B.C. 9.15.3.4. & 9.17.3.

-FIXED COLUMN -AMIN, 3 1/2" (90mm) DIA. W/ 3/16" (4.76mm) WALL THICKNESS -FOR STEEL BEAMS, CLIPS @ TOP & MIN. 6" X 4" X 1/4" (152mmX 100mm) 6.35mm) STEEL BTM. PLATE FOR WOOD BEAMS, MIN. 4"X4"X1/4" (100mmX 100mm X 6.35mm) STEEL TOP & BTM. PLATES, OR TOP PLATE TO EXTEND MIN. WIDTH OF BEAA ADJUSTABLE COLUMNS TO CONFORM TO CAN//CGSB-7.2-M WHERE IMPOSED LOAD DOES NOT EXCEED 36 KN (O.B.C. 9.17.3.4.)

-MAX. 9'-10" (2997mm) - 34" X 34" X 16" - (860mmX 860mmX 400mm) - 44" X 44" X 21" - (1120mmX 1120mmX 530mm) 3 STOREY

- 40" X 40" X 19" 1010mmX 1010mmX 480mm) -MAX. 16'-0" (4880mm) ~51" X 51" X 24" -WHERE COL. SITS ON FDN. WALL, USE 4"X 5"X 5/8" (100mmX 200mmX 16mm) STEEL PLATE WITH 2-5/8" (16mm) ANCHOR BOLTS

9 WOOD COLUMN: O.B.C. 9.17.4.1. -5 1/2" X 5 1/2" (140mm X 140mm) SOLID WOOD COLUMN. METAL SHOE ANCHORED TO FOOTING

-velal Shue Anchoked 10 FOOTING
-25" X 25" X 12" (640mmX 640mmX 300mm) CONC. PAD (1 FLOOR SUPPORTED W/ 9"-10" COL. SPACING)
-34" X 34" X 14" (860mmX 860mmX 360mm) CONC. PAD (2 FLOORS SUPPORTED W/ 9"-10" COL. SPACING) 10) BLOCK PARTY WALL BEAM END BEARING: (WOOD BEAM / GIRDER TRUSSES) -2"X8"X12" LEDGER BOARD FASTENED W/ 2/ 1/2" ANCHOR BOLTS @ 4" O.C. WHERE WOOD BEAMS BEAR ON FIREWALLS USE GENERAL NOTE 11 WHERE REQUIRED TO OBTAIN 5" SEPARATION DISTANCE

TWEEN ADJACENT BEAMS 11) BLOCK PARTY WALL BEAM END BEARING: (STEEL BEAM) -12"X11"X 5/8" STL. PLATE ON TOP OF SOLID CONCRETE BLOCK WITH 2-1/2" $\varnothing$  x8" ANCHOR BOLTS.

WALL ASSEMBLIES: 14 FOUNDATION WALL:

O.B.C. 9.15.4.2

-FOR WALLS NOT EXCEEDING 8'-2" (2500mm) IN LATERALLY SUPPORTED neight.
-6" (200mm) SOLID 2200psi (15MPa) CONCRETE
-MAX, UNSUPPORTED HEIGHT OF 3-11" (1200mm) & MAX, SUPPORTED HEIGHT
OF 7'-0" (2150mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR.
-FOR WALLS NOT EXCEEDING 9'-0" (2750mm) IN LATERALLY SUPPORTED

HEIGHT.
-10" (250mm) SOUID 2200psi (15MPa) CONCRETE
-MAX. UNSUPPORTED HEIGHT OF 4"-7" (1400mm) & MAX. SUPPORTED HEIGHT OF 8'-6" (2600mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR LATERAL SUPPORT PROVIDED BY ANCHORED SILL PLATE TO JOISTS. FOR CONDITIONS EXCEEDING THESE MAXIMUMS AN ALTERNATIVE IN

ONFORMANCE TO O.B.C. - T.9.15.4.1 SHALL BE USED OR IT SHALL BE DESIGNED UNDER O.B.C.-PART 4

"WALL SHALL EXTEND A MIN. 5 7/8" (150mm) ABOVE GRADE

-INSULATE W/ R12 (RSI 2.11) FROM UNDERSIDE OF SUBFLOOR TO NOT
MORE THAN 8" (200mm) ABOVE FINISHED FLOOR OF BASEMENT
(20NE 1. 0.8.C. 1.2.1.1.2.A.)

-BACK FILL W/ NON-FROST SUSCEPTIBLE SOIL

REDUCTION OF THICKNESS:

-WHERE THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO LLOW MASONRY FACING, THE MIN. REDUCED THICKNESS SHALL NOT BE LESS IAN 3-1/2" (90mm) THICK. TIE TO FACING MATERIAL WITH METAL TIES SPACED MAX. @ 7 7/8" (200mm) -TIE TO FACING WATERALL WITH METAL TIES SPACED MAX. 9 / 7/0 (2001)
VERTICALLY O.C. & 2-11" (900mm) HORIZONTALLY MORTAR
WHERE WALL SE REDUCED FOR JOSTS, THE REDUCED THICKNESS SHALL BE
MAX. 13-3/4" (350mm) HIGH & MIN. 3-1/2" (90mm) THICK

DAMPPROOFING & WATERPROOFING:

-DAMPPROOF THE EXTERIOR FACE OF WALL BELOW GRADE AS PER O.B.C. HERE INSULATION EXTENDS TO MORE THAN 4'-9" (1450mm). BELOW GRADE, A FDN, WALL DRAINAGE LAYER SHALL BE PROVIDED IN CONFORMANCE TO A FIDN. WALL DRAINAGE LAYER SHALL BE PROVIDED IN CONFORMANCE TO O.B.C. 9.1.42.1/2(3) (4)

-FINISHED BASEMENTS SHALL HAVE INTERIOR DAMPPROOFING EXTENDING FROMSLAB TO GRADE LEVEL & SHALL CONFORM TO O.B.C. 9.13.3.3.(3)

-WHERE HYDROSTATIC PRESSURE OCCURS, FDN. WALLS SHALL BE WATERPROOFED AS PER O.B.C. 9.13.3.

-WALLS THAT ARE WATERPROOFED DO NOT REQUIRE DAMPPROOFING.

140 FOUNDATION WALLS @ UNSUPPORTED OPENINGS: -2-20M BARS IN TOP PORTION OF WALL (UP TO 8'-0" OPENING) -3-20M BARS IN TOP PORTION OF WALL (8"-0" TO 10"-0" OPENING)
-4-20M BARS IN TOP PORTION OF WALL (10"-0" TO 15"-0" OPENING)
-BARS STACKED VERTICALLY AT INTERIOR FACE OF WALL. -BARS TO HAVE MIN. 2" (50mm) CONCRETE COVER -BARS TO EXTEND 2'-0" (600mm) BEYOND BOTH SIDES OF OPENING.

15) FRAME WALL CONSTRUCTION: O.B.C. 9.23.
SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16.
-2" X 8" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C.
-MIN. R22 (RSI 3.87) INSULATION (ZONE 1. O.B.C. T.2.1.1.2.A.) -CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.

- SUPPORT FOR 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. = -FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C. REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE): O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)

FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE THE FOLLOWING INSULATING MATERIAL WITH A MASS OF AT LEAST 4.8 kg/ sq.m. -REPLACE 1/2" (12.7mm) INTERIOR GYPSUM BOARD WITH 1/2" (12.7mm) TYPE 'X GYPSUM BOARD.

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE): -REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING: -NON-COMBUSTABLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS

VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER 1/2" (12.7mm)

YPSUM EXTERIOR SHEATHING WHICH REPLACES EXTERIOR PLYWOOD OR EQUIV. ALTERNATE FRAME WALL CONSTRUCTION:

O.B.C. 9.23. -SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.)
-1 1/2" (38mm) R8 (RSI 1.41) RIGID INSULATION W/TAPED JOINTS (O.B.C. -BRACEW/ CONT. 16 GAUGE STEEL T BRACES FROM TOP PLATE TO BTM. PLATE FOR THE FULL LENGTH OF WALL, OR CONT, 2" X 4" (38mmX 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO BTM. PLATE FOR -9" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C.

-2. A 4 (SOITH AND STOREYS.

-R14 (RS12.46) INSULATION (ZONE 1. O.B.C. T.2.1.1.2.A.)
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.-9.25.3. &

9.25.4.
-1/2" (12.7mm) GYPSUM BOARD.
NOTE-SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmX 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LSSS THAN 4-0" LIMITING DISTANCE):

O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN) FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS: -ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16. BETWEEN RIGID INSULATION AND WOOD STUD.
-REPLACE R14 [R31 2.46] INSULATION WITH R14 [R31 2.46] ABSORPTIVE
INSULATING MATERIAL WITH A MASS OF AT IEAST 2.8 kg/ sg.m.
-REPLACE 1/2"(12.7mm) GY?SUM BD. W/ 1/2" (12.7mm) TYPE "X" GYPSUM BD.

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE): -REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING: -NON-COMBUSTABLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).

-VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING PAPER

15b FRAME WALL CONSTRUCTION @ GARAGE:

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.)

-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.

-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 7.23.10. -2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C.

-2 X 4 (39mm x 97mm) WCD S10DS @ 16 (400mm) O.C. -1/2" (12.7mm) GYPSUM BOARD NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. = -FOR 2 FLOORS SUPPORTED ABOVE. 2" X 4" (38mmX 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C. -FOR 3 FLOORS SUPPORTED ABOVE. 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE): O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN) FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-ADD ABSORPTIVE MATERIAL WITH A MASS OF AT LEAST 2.8 kg/ sq.m REPLACE 1/2"(12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE"X" GYPSUM BD. REQ. FOR FIRE RATING (LESS THAN 2-0" LIMITING DISTANCE): -REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND

ADD/REPLACE THE FOLLOWING: -NON-COMBUSTABLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS

ON VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING PAPER OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING WHICH REPLACES EXTERIOR PLYWOOD OR EQUIV. 16 BRICK VENEER CONSTRUCTION:

3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36'-1" (11m) MAX. HEIGHT -NJIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. RASE FLASHING UP TO 5 7/8" (150mm) BEHIND WALL SHEATHING

-BASE FLASHING UP TO 9 1/8 (130mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.(2))
-BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER 1-1" (25mm) AIR SPACE
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C.

-72"X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C. -MIN. R22 (RSI 3.87) INSULATION (ZONE 1. O.B.C. T.2.1.1.2.A.) CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. 

REQ. FOR FIRE RATING (LESS THAN 4'-0' LIMITING DISTANCE): O.B.C. SB-3 WALL = EWID (STC = N/A, FIRE = 45 MIN) FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-REPLACE R22 (RSI 3.87) INSULATION WITH R22 (RSI 3.87) ABSORPTIVE
INSULATING MATERIAL WITH A MASS OF AT LEAST 4.8 kg/sq.m.
-REPLACE 1/2"(12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE"X GYPSUM BD.

ALTERNATE BRICK VENEER CONSTRUCTION:

O.B.C. 9.23. 3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36'-1" (11m) MAX. MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL -PROVIDE WEEP HOLES @ 2-7" (800mm)O.C. @ 8TM, COURSE & OVER

OPENINGS -BASE FLASHING UP TO 5 7/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (0.8.C. 9.20.13.6.(2) ) -BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER -1 1/2" (38mm) R8 (RSI 1.41) RIGID INSULATION W/ TAPED JOINTS (O.B.C.

7.27.3.4.) -2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) D.C. ON BOTTOM FLR. WHEN 3 STOREYS BRACE W/ CONT. 16 GAUGE STEEL T' BRACES FROM TOP PLATE TO BTM. PLATE FOR THE FULL LENGTH OF WALL, OR -CONT. 2" X 4" (38mmX 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG, FROM TOP PLATE TO BTM. PLATE FOR FULL LENGTH OF WALI NUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. - 9,25.3. &

7.20.4. 1/2" (12.7mm) GYPSUM BOARD NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. = -FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmX 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12' (300mm) O.C. -FOR 3 FLOORS SUPPORTED ABOVE, 2"X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12' (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN) FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16. BETWEEN RIGID INSULATION AND WOOD STUD. PREPLACE R14 (RSI 2.46) INSULATION WITH R14 (RSI 2.46) ABSORPTIVE
INSULATING MATERIAL WITH A MASS OF AT LEAST 2.8 kg/ sg.m.
-REPLACE 1/2'(12.7mm) GYPSUM BD. W/ 1/2'' (12.7mm) TYPE 'X' GYPSUM BD.

16b BRICK VENEER CONSTRUCTION @ GARAGE

-MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL SPACING
PROVIDE WEEP HOLES @ 2'-7" (800mm)O.C. @ BTM. COURSE & OVER DPENINGS BASE FLASHING UP TO 5 7/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.(2) )
-BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER I" (25mm) AIR SPACE WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2. 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C.

-3-1/2' (90mm) FACE BRICK OR 4' (100mm) STONE @ 36-1" (11m) MAX.

2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. -2 X 4 (36mmX 69mm) WOOD STUDS @ 16 (400mm) O.C. -1/2" (12.7mm) GYPSUM BOARD NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. = -FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmX 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C. -FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-ADD R15 (RSI 2.64) ABSORPTIVE MATERIAL WITH A MASS OF AT LEAST 2.8 kg/

REPLACE 1/2"(12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE "X" GYPSUM BD. 17 INTERIOR STUD WALLS:

O.B.C. T.9.23.10.1 -2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. OR -2" X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C. W/ - DOUBLE 2" X 4" OR 2" X 6" TOP PLATES AND SINGLE BOTTOM PLATE 1/2" (12.7mm) GYPSUM BOARD BOTH SIDES.

18 BEARING STUD WALL (BASEMENT): 2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. OR -2" X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C. W DBL, 2" X 4" OR 2" X 6" TOP PLATE. - DBL 2" X 4" OR 2" X 6" 10P PLAIE. - 2" X 4" OR 2" X 6" BOTTOM PLATE ON DAMPPROOFING MATERIAL. - 1/2" (12.7mm) GYPSUM BOARD BOTH SIDES. - 1/2" (12.7mm) DIA. ANCHOR BOLTS @ 7"-10" (2400mm) O.C. - FOOTING AS PER GENERAL NOTE #2 W/ 4" CONC. CURB

PARTY WALL - BLOCK:

O.B.C. SB-3 WALL = B6e (STC = 57, FIRE = 2 HR)

-MIN. 1 HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF FOOTINGS TO THE U/S OF ROOF DECK -SPACE BETWEEN TOP OF WALL & ROOF DECK SHALL BE TIGHTLY FILLED W/ MINERAL WOOL OR NONCOMBUSTIBLE MATERIAL & CAULKED TO 1/2" (12.7mm) GYPSUM BOARD W/TAPED JOINTS BOTH SIDES -2' X 2' (38mmX 38mm) WOOD STRAPPING @ 24" (600mm) O.C. BOTH

BSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF 90% OF THE -ABSORTIVE WATERIAL ON BOTH SIDES FILLING A MINIMUM OF 70% OF CAVITY. -7 1/2" (190mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE) -STAGGER JOISTS & BEAMS MIN. 3 1/2" (90mm) @ PARTY WALLS AS PER O.B.C. 9.10.9.9.(1) & TABLE 2.1.1. SB-2 ACOUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE (2) TO TABLE 1)

190 PARTY WALL - BLOCK (AGAINST GARAGE): O.B.C. SB-3 WALL = B5c (STC = 51, FIRE = 2 HR)

-MIN. 1 HR FIRE-RESISTANCE RATING CONTINUOUS
-1/2" (12.7mm) GYPSUM BOARD
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. & 9.25.4. -2" X 4" (38mmX 89mm) WOOD STRAPPING @ 16" (400mm) O.C.

-2" X + (28mmX 89mm) WOOLD STRAPPING @ 16" (4UUmm) O.C. -20 (RSI 3-22) RIGID INSULATION -7 1/2" (190mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE) -1/2" (12.7mm) GYPSUM BOARD @ WALL & U/S OF CEILING BETWEEN HOUSE AND GARAGE -TAPE AND SEAL ALL JOINTS GAS TIGHT REQ. INSULATION VALUES:

INSULATION VALUES PROVIDED BY CAN/CSA-F280-M90 - NORD INSULATION = 20.0C - LOW DENSITY CONCRETE BLOCK = 1.70 - WOOD FRAME W/ GYPSUM = 2.72 - AIR FILM - MOVING = 0.68 - AIR FILM - VIII = 0.68 -AIR FILM - STILL TOTAL "R" VALUE

19b FIREWALL:
O.B.C. 9.10.11. & 3.1.10. & SB-3 WALL = B6e (STC = 57, FIRE = 2 HR) - ONE FIREWALL IS REQUIRED FOR EVERY 6460 S.F. (600 SQ.M) OF BUILDING AREA, O.B.C. T.3.2.2.47. 1/2" (12.7mm) GYPSUM BOARD W/ TAPED JOINTS -2" X 2" (38mmX 38mm) WOOD STRAPPING @ 24" (600mm) O.C. ON BOTH SIDES SOUND ABSORPTIVE MATERIAL EACH SIDE FILLING 90% OF THE CAVITY -SOUND ASSORTINE MALEXALE ARCH SIDE FILLING YOU OF THE CAVITY
-7 1/2" (190mm) CONC. BLOCK, MIN. 21 HR. FIRE FRESISTANT RATING
-EVERY FIREWALL SHALL BE CONTINUOUS THROUGH ALL BUILDING STOREYS
-STAGGER JOISTS & BEAMS MIN. 5" (130mm) @ FIRE WALLS AS PER O.B.C. 9.10.9.9.(1) & TABLE 2.1.1 SB-2
-ACOUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE (2) TO TABLE 1) -PROTRUDE PAST FASCIA @ EAVES W/ BRICK CORBELLING -EXTEND 5 7/8" (150mm) ABOVE ROOF SURFACES & HAVE ALUMINUM CAP W/ THROUGH WALL FLASHING PER O.B.C. 3.1.10.4.(1) WHERE THE DIFFERENCE IN HEIGHT RETWEEN AD IACENT POORS IS GREATER

(20) PARTY WALL - FOUNDATION:
O.B.C. 9.15.4.2.
-77/8" (200mm) SOLID CONC. FOUNDATION WALL @ 2200psi (15MPa)

COMPRESSIVE STRENGTH AFTER 28 DAYS
-FOUNDATION WALL TO REST ON FOOTING PER GENERAL NOTE #2 (21) PARTY WALL - WOOD STUD:
O.B.C. SB-3 WALL = W13a (STC = 57, FIRE = 1 HR) -MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF FOOTINGS TO THE U/S OF ROOF DECK
2 ROWS 2'X4"(38mmX 89mm) STUDS @ 16"(400mm) O.C. W/ SEPARATE 2" X 4" (39mmX 89mm) BOTTOM PLATE & SEPARATE DOUBLE 2" X 4" mX 89mm) TOP PLATES SOUND ABSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF 90% OF THE CAVITY. -5/8" (16mm) TYPE 'X' GYPSUM BOARD BOTH SIDES W/ JOINTS TAPED &

"ACOUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE (2) TO TABLE 1) NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmX 89mm) STUDS ARE
REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C

GARAGE WALL & CEILING:

O.B.C. 9.10.9.16.(3) -1/2" (12.7mm) GYPSUM BOARD ON BOTH SIDES OF WALL & U/S OF CEILING RETWEEN HOUSE AND GARAGE

BETWEEN HOUSE AND GARAGE
-TAPE AND SEAL ALL JOINTS GAS TIGHT
-R22 (RSI 3.87) INSULATION IN WALLS,
-R31 (RSI 5.41) INSULATION IN CEILINGS W/ FLOOR ABOVE
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.9.25.3. 8, 9.25.4. FOR FLOOR ABOVE
-INSULATION AROUND DUCTS AND PIPING NOT TO ENCROACH MIN.
REQUIRED CARAGE AREA (REFER TO MUNICIPAL STANDARDS).
-1/2" (1/2.7mm) GYPSUM BOARD 1/2" (12.7mm) GYPSUM BOARD ROOF FRAMING MEMBERS ARE FASTENED TO TOP PLATES WITH 4 - 3 1/4" (82mm) TOE NAILS
-BOTTOM PLATES ARE FASTENED TO FLOOR JOISTS, BLOCKING OR RIM JOIST WITH 3 1/4" (82mm) NAILS AT 7 7/8" (200mm) O.C.

220 WALLS ADJACENT TO ATTIC SPACE /2" (12.7mm) GYPSUM BOARD :ONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.-9.25.3. & 9.25.4. .25.5. & 7.25.4. 2' X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C. R22 (RSI 3.87) INSULATION 22 (13:3.07) INSOLATION /2" (12:7mm) GYPSUM BOARD OR 1/4" (6mm) PLYWOOD SHEATHING ON ATTIC SIDE.

ATTIC ACCESS TO BE PROVIDED AS PER O.B.C. 9.19.2.1. 23) DOUBLE VOLUME WALLS:

-3/8" (9.5mm) PLYWOOD, OSB OR WATERBOARD SHEATHING REFER TO PLAN FOR STUD SPECIFICATION STUDS FASTENED AT TOP & BOTTOM WITH 3/ 3-1/4" (82mm) TOE NAILS DOUBLE TOP PLATES FASTENED TOGETHER WITH 3" (76mm) AT -DOUBLE FOR PLATES FASTENED TOGETHER WITH 3 (76mm) AT 7/8" (200mm) O.C.
-SOLID BRIDGING AT 3"-11" (1200mm) O.C.
-MIN. R22 (RSI 3.87) INSULATION (20NE 1. O.B.C. T.2.1.1.2.A.)
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE WIT 9.25.3. 8.9.25.9.

24 EXPOSED FLOOR:
-FLOOR AS PER NO FLOOR AS PER NOTE # 28 ONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. & 9.25.4.
-R31 (RSI 5.46) INSULATION
-VENTED ALLIABNUM SOFE

SUNKEN FINISHED AREAS: JUNEAU THISTIEU AREAS.

- LISE SCILID BUILT-UP WOOD BEARING POST TO SUPPORT SUNKEN AREA
AT FOUNDATION WALLS. EXTEND FOOTINGS TO SUPPORT POSTS.

- WHERE GRADING CONDITIONS WILL ALLOW, CHECK FOUNDATION
WALLS INSTEAD OF USING BEARING POSTS.

-FLOOR STRUCTURE AS PER NOTE # 28. 25 DOUBLE MASONRY WYTHE WALL:

O.B.C. 9.20.8.2. -3 1/2" MASONRY VENEER ON 2" MORTAR JOINT ON 3 1/2" MASONRY VENEER -WITHES TO BETTED W/ METAL TIES INSTALLED AS PER O.B.C. 9,20.9.4. SILL PLATE REQUIRED FOR ROOF AND CEILING FRAMING MEMBERS -6" SILL W/2" BEARING ON EACH SIDE & ANCHOR BOLTS @ 4'-0" C NOTE: MASONRY TO BE SOLID & MORTAR JOINT FILLED SOLID FOR FLOOR JOISTS BEARING ON WYTHES. FLOOR JOISTS ARE NOT TO PROJECT INTO CAVITY

(34) ATTIC ACCESS HATCH:

GENERAL:

O.B.C. 9.8.4.

ANGLED TREADS:

HANDRAILS:

HEIGHT: O.B.C. 9.8.7.4

350) PUBLIC STAIRS:

-MIN. RUN

-MIN. TREAD

HANDRAILS:

DIRECTION

O.B.C. 9.8.9.6

36 INTERIOR GUARDS:
O.B.C. SB-7 & 9.8.8.3.

O.B.C. SB-7 & 9.8.8.3.

UARDS TO BE 3'-6" (1070mm)

Sob EXTERIOR GUARDS @ JULIET BALCONY:

37 -LINEN CLOSET 4 SHELVES MIN. 1'-2" (350mm) DEEP

AIR CHANGE PER HOUR, O.B.C.- 9.32.1.3.(3)

40 -1"X2" (19mmX38mm) BOTH SIDES OF STEEL.

CONCRETE W/ 6 mil POLYETHYLENE.

(39) -CAPPED DRYER VENT

(360) EXTERIOR GUARDS:

-MAX. NOSING

-MIN. HEADROOM

O.B.C. 9.8.4. -MAX. RISE

-MAX. RISE = 7-/18
-MIN. RUN = 8-1/4"
-MIN. TREAD = 9-1/4"
-MAX. NOSING = 1"
-MAY. HOBOROOM = 6-5"
-MIN. WIDTH = 2-10"
(BETWEEN WALL FACES)

N. WIDTH = 2"-11" (9 (EXIT STAIRS, BETWEEN GUARDS)

-MIN. RUN = 57/8" (150mm) -MIN. AVG. RUN = 77/8" (200mm)

35 PRIVATE STAIRS:

-MAX. RISE

-19 3/4' X 27 1/2' (500mm X 700mm) ATTIC HATCH WITH WEATHERSTRIPPING & BACKED W/ R20 (RSI 3.52) INSULATION.

= 7-7/8" (200mm) = 8-1/4" (210mm) = 9-1/4" (235mm) = 1" (25mm) = 6'-5" (1950mm)

-Min. AVG. RUN = 7/78 (200mm)
-FINISHED RAILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS
-EXTERIOR CONC. STEPS TO HAVE MIN. 9 1/4" (235mm) TREAD &

WAX. 7 7/8" (200mm) RISE FOUND. WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2

WAYS, LANDINGS OR POSTS AT CHANGES IN DIRECTION

-FTG. FOR FOUND. WALL TO BE MIN. 4'-0" (1220mm) BELOW GRADE

O.B.C., 7.0.7.4

- 2-10" (865mm) MIN. TO 3-2" (965mm) MAX.
- 3-5" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS
- MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A
STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING

-HANDRAILS AND PROJECTIONS BELOW HANDRAILS INCLUDING STEP

= 7-3/32' (180mm)

-FOUND. WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2
-FTG. FOR FOUND. WALL TO BE MIN. 4'-0" (1220mm) BELOW GRADE

O.B.C. 9.8.7 -ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm)

-TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3-7" (1100mm)
-TWO HANDRAILS ARE REQUIRED ON CURVED STAIRS OF ANY WIDTH

-HANDRAILS ARE TO BE CONTINUOUS INCLUDING AT LANDINGS EXCEPT WHERE INTERRUPTED BY DOOR WAYS OR NEWEL POSTS AT CHANGES IN

U.B.C., Y.B.7.4.

- 2-10" (855mm) MIN. TO 3-2" (945mm) MAX.

- 3-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS)
- MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A

STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING

- HANDRAILS AND PROJECTIONS BELOW HANDRAILS INCLUDING STEP STRINGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED

- ONE HAND RAIL SHALL EXTEND HORIZONTALLY NOT LESS THAN 11 3/4"

O.B.C. 9.8.9.6

-TREADS ARE TO BE WEAR AND SLIP RESISTANT, SMOOTH, EVEN AND FREE FROM DEFECTS PER OBC 9.8.9.6.(4)

-STAIRS AND RAMPS SHALL HAVE A COLOUR CONTRAST OR DISTINCTIVE VISUAL PATTERN TO DEMARCATE THE LEADING EDGE OF THE TREADS, LANDING AND THE BEGINNING AND END OF A RAMP.

-GUARDS TO BE 3'-6" (1070mm) HIGH -FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2'-11" (900mm) HIGH

-PICKETS TO HAVE 4" (100mm) MAX. SPACING -GUARDS FOR FLIGHTS OF STEPS (EXCEPT EXIT STAIRS) TO BE 2'-11" (900mm) HIGH

-GUARDS ARE REQUIRED WHEN WALKING SURFACE TO GRADE IS GREATER THAN

-GUARDS TO BE 3-6" (1070mm)
-FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2-11" (900mm) HIGH
-FOR DWELLING UNITS GUARDS TO BE 3'-6" (1070mm) HIGH WHERE WALKING
SURFACE IS MORE THAN 5-11" (1800mm) ABOVE ADJACENT GRADE.
-PICKETS TO HAVE 4" (100mm) MAX. SPACING
-PROVIDE MID-SPAN POSTS AS PER SB-7.
-GUARDS FOR FLIGHTS OF STEPS (EXCEPT EXIT STAIRS) TO BE 2-11" (900mm) HIGH

-FOR RAILING SPANNING MAXIMUM OF 6-0". -PROVIDE PREFIN. METAL RAILING W/76mm VERTICAL OPENING TO

GUNTORM WITH O.B.C. APPENDIX A-9.8.8.5.
-GUARDS TO BE 3"-6" (1070mm)
-FOR DWELLING UNITS GUARDS TO BE 2"-11" (900mm) WHERE FLOOR TO GRADE DIFFERENCE B LESS THAN 5"-11" (1800mm) AS PER O.B.C.
9.8.8.2. OR
-FOR DWELLING UNITS GUARDS AND SOCIAL STREET OF THE STREET OF THE

9.8.8.2. OR . -FOR DWELLING UNITS GUARDS TO BE 3'-6" WHERE FLOOR TO GRADE DIFFERENCE IS 5'-11" (1800mm) OR GREATER AS PER O. B.C., 9.8.8.2. -VERTICAL END RAILING ANCHORED TO CORNER DOUBLE STUDS USING 3 ROWS OF 3/8"Ø MIN. ANCHOR BOLTS EQUALLY SPACED WITH 3" MIN.

-PROVIDE SAME ANCHOR BOLTS @ 36" O.C. FOR BASE PLATE CONNECTION.

-WASHROOMS TO BE MECHANICALLY VENTED TO PROVIDE AT LEAST ONE

-WOOD FRAMING MEMBERS SUPPORTED ON CONCRETE IN CONTACT

with Ground or fill shall be pressure treated or separated from

INCLUDES WINDOWS OVER STAIRS, RAMPS AND LANDING

(300mm) BEYOND THE TOP & BOTTOM OF EACH STAIR AS

= 6'-9" -MIN. WIDTH = 2'-11" (900mm)

(EXT STAIRS, BETWEEN GUARDS)

-FINISHED RAILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS

(280mm) (280mm)

STRINGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED

-ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm)

HANDRAILS ARE TO BE CONTINUOUS EXCEPT WHERE INTERRUPTED BY DOOR

-TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3-7" (1100mm)
-ONE HANDRAIL IS REQUIRED ON CURVED STAIRS OF ANY WIDTH WITHIN

250 CORBEL MASONRY VENEER: -MASONRY VENEER TO BE CORBELLED AS PER O.B.C. 9.20.12.3.(1) FLOOR ASSEMBLIES:

26 SILL PLATE: O.B.C. 9.23.7. -2" X 4" (38mm X 89mm) PLATE -2 A 4 (301611) PLAN ANCHOR BOLTS @ 7-10" (2400mm) O.C. FASTENED TO PLATE W/ NUTS AND WASHERS & SHALL BE EMBEDDED NOT LESS THAN 4" (100mm) INTO FOUNDATION WALL .
-SILL PLATE TO BE CAULKED, OR PLACED ON A LAYER NOT LESS THAN 1"

(25mm) THICK BEFORE COMPRESSING, OR FOAM GASKET, OR PLACED ON FULL BED OF MORTAR. 27 BRIDGING & STRAPPING:

-1" X 3" (19mmX 64mm) NAILED TO U/S OF JOISTS @ MAX, 6"-11" (2100mm) O.C. -FASTENED TO SILL OR HEADER @ ENDS 1" X 3" (19mmX 64mm) OR 2" X 2" (38mmX 38mm) CROSS BRIDGING @ MAX. 6-11" (2)00mm) O.C. c) BRIDGING & STRAPPING -0) & DI USED TOGETHER OR -1 1/2" (28mm) SOLID BLOCKING @ MAX. 6'-11" (2100mm) O.C. USED WITH

STRAPPING (a) d) FURRING OR PANEL TYPE CEILING STRAPPING NOT REQUIRED IF FURRING STRIPS OR PANEL TYPE CEILING FINISH IS ATTACHED DIRECTLY TO JOISTS.

28 FLOOR ASSEMBLY: O.B.C. 9.23.14.3. 9.23.14.4 5/8" (15.9mm) WAFERBOARD (R-1 GRADE) OR EQUIVALENT FLOOR JOISTS AS PER FLOOR PLANS

29 PORCH SLABS ABOVE COLD CELLAR: O.B.C. 9.39.1.4.
-REINFORCED CONCRETE SLABS ABOVE COLD CELLARS THAT ARE SUPPORTED ON FOUNDATION WALLS NOT TO EXCEED 8'-2" ON FOUNDATION WALLS NOT TO EXCEED 8-2"

4 //8" (125mm) 4650 psi (32 Mpg) ( CONC. SLAB WITH 5 TO 8% AIR ENTRAINMENT
-REINFORCE WITH 10M BARS @ 7 7/8" (200mm) EACH WAY
-1 1/4" (30mm) CLEAR COVER FROM THE BOTTOM OF THE SLAB
-2" (75mm) END BEARING ON FOUNDATION WALL
-23 5/8" (600mm) X 23 5/8" (600mm) 10M DOWELS @ 23 5/8" (600mm) O.C.

30) EXTERIOR BALCONY ASSEMBLY:
-1 1/4" X 3 1/2" PRESSURE TREATED DECKING W/ 1/4" SPACING
-2"X" WOOD PURLINS (CUIT DIAGONALLY) @ 12" O.C. LAYING UNFASTENED
ON SINGLE PLY WATERPROOF ROOF MEMBRANE OR EQUIVALENT ON 5/8" 15.9mm) EXTERIOR GRADE PLYWOOD SHEATHING ON 2"X4" WOOD PURLINS (CUT DIAGONALLY) @ 12" O.C. DIRECTLY ON 2"X8" ROOF JOISTS @ 12" O.C. (OR AS NOTED ON PLAN) EXTERIOR GUARD AS PER #36a

- SLOPE ASSEMBLY MINIMUM 2% TO ROOF SCUPPER REQUIRED FOR OVER HEATED SPACES: -ADD 2"x2" (38mm x 38mm) CROSS PURLINS @ 16" (400mm) O.C. FOR VENTILATION OVER JOISTS (OBC 9.19.1.2. VENTING NOT LESS THAN 1/150 OF CEILING AREA)
-ADD R31 (RS15.46) INSULATION BETWEEN JOISTS
-ADD CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.

& 9.25.4.
-ADD 1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR -ADD 5/8' (15.9mm) GYPSUM BOARD W/ PAINTED CEILING OR EXTERIOR FLAT ROOF ASSEMBLY: SINGLE PLY WATERPROOF ROOF MEMBRANE OR EQUIVALENT
INSTALLED PER MANUFACTURER'S SPECIFICATIONS.
1/4" EXTERIOR GRADE WOOD PANEL TYPE UNDERLAY TAPERED PURLINS
LOPED MIN. 2% TO ROOF SCUPPER.

-3/8" EXTERIOR GRADE PLYWOOD SHEATHING ON -2"X8" ROOF JOISTS @ 12" O.C. (OR AS NOTED ON PLAN) REQUIRED FOR OVER HEATED SPACES: -ADD 2"x2" (38mm x 38mm) CROSS PURLINS @ 16" (400mm) O.C. FOR VENTILATION OVER JOISTS (OBC 9.19.1.2, VENTING NOT LESS THAN 1/150 OF CELING AREA)

-ADD R31 (RS15.46) INSULATION BETWEEN JOISTS

-ADD CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.

G.7.20-4. -ADD 1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR -ADD 5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. T.9.29.5.3.) ROOF ASSEMBLIES

(31) TYPICAL ROOF:

-NO. 210 (30. 5KG/m2) ASPHALT SHINGLES -FOR ROOFS BETWEEN 4:12 & 8:12 PITCH PROVIDE EAVES PROTECTION TO EXTEND UP THE ROOF SLOPE MIN. 2'-11" (900mm) FROM EDGE TO A LINE NOT LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTERIOR WALL. -EAVES PROTECTION LAID BENEATH STARTER STRIP -EAVE PROTECTION NOT REQUIRED OVER UNHEATED SPACES STARTER STRIP AS PER O.B.C. 9.26.7.2

STARTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.(3)

-3/6" (10mm) PLYWOOD SHEATHING OR OSS (0°-2 ORADE) WITH "H" CLIPS

-APPROVED WOOD TRUSSES @ 24" (600mm) O.C. (REFER TO MANUFACTURERS

TRUSS BRACING AS PERTRUSS MANUFACTURER -EAVESTROUGH ON PREFINISHED FASCIA AND VENTED SOFFIT IVINYL OR -ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH, 50% AT SOFFIT.

32 CEILING: -R50 (RS) 8.8) INSULATION -CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. /2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR -5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. T.9.29.5.3.)

320 VAULTED OR CATHEDRAL CEILING: O.B.C. 9.26. & TABLE A4 -FOR ROOFS BETWEEN 4:12 & 8:12 PITCH PROVIDE FAVES PROTECTION TO EXTEND UP THE ROOF SLOPE MIN. 2'-11" (900mm) FROM FDGE TO A LINE NOT LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTERIOR WALL LESS THAN 1.2" (300mm) PAST THE INSIDE FACE OF EXTERIOR WALL -EAVES PROTECTION LAID BENEATH STARTER STRIP.

EAVE PROTECTION NOT REQUIRED OVER UNHEATED SPACES OR WHERE ROOF SLOPES ARE 8:12 OR GREATER PER O.B.C. 9.26.5.1.

-STARTER STRIP AS PER O.B.C. 9.26.7.2.

-STARTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.(3)

-3/8" (10mm) PLYWOOD SHEATHING OR OSS (0-2 GRADE) WITH "H" CLIPS. -2"X8" (38mm x 184mm) @ 16" O.C. W/ 2"X2" (38mm x 38mm) CROSS PURLINS @ 24" O.C. MAX. SPAN 13"-3" (4050mm) OR

-2"X10" (38mm x 235mm) @ 16" O.C. W/ 2"X2" (38mm x 38mm) CROSS PURLINS @ 24" O.C. MAX. SPAN 17"-0" (5180mm)

-7"X16" (3515.46) INSULATION

-R31 (RSI 5.46) INSULATION -MIN. 3" CLEARANCE FROM U/S OF ROOF SHEATHING TO INSULATION -CONTINUOUS AIN, V. ... O.B.C. 9.25.3. & 9.25.4. TINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE WITH

(33) CONVENTIONAL FRAMING:

SMOKE ALARM (44)

VENTS AND INTAKES

COLD CELLAR VENT (50)

WATERPROOF

EXHAUST FAN

STOVE VENT

DRYER VENT

DOUBLE JOIST

G.T. GIRDER TRUSS

PRESSURE TREATED LUMBER

A.F.F. ABOVE FINISHED FLOOR

3-1/2" X 3-1/2" X 1/4" L L13 5-7/8" X 3-1/2" X 3/8" L

4" X 3-1/2" X 1/4" L L14 5-7/8" X 3-1/2" X 1/2" L

FIRE PLACE VENT

# HOSE BIB

D.J.

P.T.

2/ 2" X 8" SPR

2/ 2" X 10" SPR

2/ 2" X 12" SPR

O.B.C. TABLE A6 OR A7 -2" X 6" (38mm X 140mm) RAFTERS @ 16" (400mm) O.C. MAX. SPAN 12'-9" -2"X4" (38mm X 89mm) COLLAR TIES AT MIDSPANS CEILING JOISTS TO BE 2" X 6" (38mmX 140mm) @ 16" (400mm) O.C. JNLESS OTHERWISE NOTED.

-HIP & VALLEY RAFTERS TO BE MIN. 2" (50mm) LARGER THAN COMMON RAFTERS & MIN. 1 1/2" (38mm) THICK.

 $\mathbf{H}$ 

**(G)** 

 $\boxtimes$ 

 $\boxtimes$ 

GB

LINTELS

CARBON MONOXIDE ALARM (CMA) 45

EXT. LIGHT FIXTURE

HYDRO METER

FLOOR DRAIN

SOLID BEARING

POINT LOAD

FLAT ARCH

2 STORY WAL

FG FIXED GLAZING

BG BLACK GLASS

L10 4-7/8" X 3-1/2" X 5/16" L L15 5-7/8" X 4" X 1/2

L11 4-7/8" X 3-1/2" X 3/8" L L16 7-1/8" X 4" X 3/8

GLASS BLOCK

U/S UNDER SIDE

GAS METER

**LEGEND** 

42 -PRECAST CONC. STEP
-2 RISERS MAXIMUM PERMITTED TO BE LAID ON GROUND <u>DOORS</u> 865x2030x45 (2'10"x6'8"x1-3/4 8 815x2030x35 (2'8"x6'8"x1-3/8") 760x2030x35 (2'6"x6'8"x1-3/8" 710x2030x35 (2'4"x6'8"x1-3/8") 460x2030x35 (1'6"x6'8"x1-3/8") 610x2030x35 (2'0"x6'8"x1-3/8") OVER SIZED EXTERIOR DOOR

STEEL BEAMS ST1 W 6 X 15 ST2 W 6 X 20 ST4 W 8 X 21 ST5 W 8 X 24 WOOD BEAMS VD1 3/2"X8"SPR WD2 4/ 2" X 8" SPR

WD4 3/2" X 10" SPR WD5 4/2" X 10" SPR WD6 5/2" X 10" SPR WD7 3/2" X 12" SPR WD8 4/2" X 12" SPR WD9 5/2" X 12" SPR WD10 2/1 3/4" X7 1/4" (2.0E) LVL WD11 3/13/4" X7 1/4" (2.0E) LVL WD12 2/1 3/4" X9 1/2" (2.0E) LVL L12 4-7/8" X 3-1/2" X 1/2" L L17 7-1/8" X 4" X 1/2" WD13 3/13/4" X9 1/2" (2.0E) LVL WD14 2/13/4" X117/8" (2.0E) LV

WD15 3/13/4" X117/8" (2.0E) LV

WD3 5/2" X 8" SPR

SMOKE ALARM, O.B.C.- 9.10.19.

-PROVIDE 1 ON EACH FLOOR INCLUDING BASEMENTS
-PROVIDE 1 IN EACH BEDROOM
-PROVIDE 1 IN EACH HALLWAY SERVICING BEDROOMS
-INSTALLED AT OR NEAR CEILING
-ALARMS TO BE CONNECTED IN CIRCUIT AND INTERCONNECTED SO ALL
ALARMS WILL BE ACTIVATED IF ANY ONE OF THEM SOUNDS AND HAVE A
VISUAL SIGNAL UNIC COMPONENT VISUAL SIGNALLING COMPONENT -ALARMS MUST BE HARDWIRED AND HAVE AN ALTERNATE POWER SOURCE THAT CAN POWER ALARM FOR 7 DAYS, FOLLOWED BY 4 MINUTES OF ALARM

CARBON MONOXIDE ALARM (CMA), O.B.C.- 9.33.4. WHERE THERE IS A FUEL BURNING APPLIANCE A CMA SHALL BE PROVIDED ADJACENT TO EACH SLEEPING AREA. -CMA TO BE WIRED IN CIRCUIT TO SOUND SMOKE ALARMS WHEN

-MAIN DOOR TO BE OPERABLE FROM INSIDE W/OUT KEY
-PROVIDE A VIEWER WITH A VIEWING ANGLE OF NOT LESS THAN 160 DEG.
UNLESS GLAZING IS PROVIDED IN DOOR OR A SIDELIGHT IS PRESENT. -R4 (RSI 0.70) WHERE A STORM DOOR IS NOT PROVIDED 47 -GARAGE MAN DOORS TO BE GAS PROOFED WITH SELF CLOSER, WEATHERSTRIPPING, THRESHOLD & DEAD BOLT PER O.B.C. 9.10.13.15.

48) -TRAVEL FROM A FLOOR LEVEL TO AN EXIT OR EGRESS DOOR SHALL BE LIMITED TO ONE FLOOR EXCEPT; ) WHERE THAT FLOOR LEVEL HAS ACCESS TO A BALCONY

WHERE THAT FLOOR LEVEL HAS A WINDOW PROVIDING AN UNOBSTRUCTED OPENING OF NOT LESS THAN 3-3" (1000mm) IN HEIGHT AND 21 5/8" (550mm) IN WIDTH; SUCH WINDOW SHALL BE LOCATED SO THAT THE SILL IS NOT MORE THAN 3'-3" (1000mm) ABOVE FLOOR AND 23-6" (7.0m) ABOVE ADJACENT GROUND LEVEL

49 EXTERIOR COLUMN W/ MASONRY PIER:

-MIN. 6"X6" (140mm X 140mm) WOOD POST ANCHORED TO PORCH SLAB W/ -TOP PORTION OF POST CLAD W/ DECOR, SURROUND PER ELEVATION -14" X 14" MASONRY VENEER SURROUND W/ PRECAST CONCRETE CAP. -REFER TO ELEVATION DRAWINGS FOR HEIGHT OF CAP. -SURROUND TO BE TIED W/ METAL TIES @ 16" (400mm) O.C. VERT. INSTALLED PER O.B.C. 9.20.9.4. -3/4" AIR SPACE AROUND POST.

-MIN. 6"X6" (140mm X 140mm) WOOD POST CLAD W/ DECOR, SURROUND (PER ELEVATION DRAWINGS) ANCHORED TO CONC. CAP W/ METAL SADDLE.
-14" X 14" MASONRY PIER TO BE CONSTRUCTED SOLID W/ PRECAST -REFER TO ELEVATION DRAWINGS FOR HEIGHT OF CAP. NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" POST

PROVIDED THAT THEY ARE IN CONFORMANCE WITH O.B.C. 9.17 49a) EXTERIOR COLUMN: ANI. 6"X6" (1 40mm X 1 40mm) WOOD POST CLAD W/ DECOR. SURROUND (PER ELEVATION DRAWINGS) ANCHORED TO PORCH SLAB W/ METAL SADDLE NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" ABOVE PROVIDED THAT THEY ARE IN ACCORDANCE WITH O.B.C. 9.17.4.

50 COLD CELLARS: FOR COLD CELLARS PROVIDE THE FOLLOWING: VENTING AREA TO BE EQUIVALENT TO 0.2% OF COLD CELLAR AREA.

-VENING AREA TO BE EQUIVALENT TO 0.2% OF COLD CELLAR AREA.
-COVER VENT W/ BUG SCREEN
-WALL MOUNTED LIGHT FIXTURE
-L1+17 FOR DOOR OPENING
-2-8" X 6-8" EXTERIOR TYPE DOOR (MIN.R-4 RST 0.7)
-INSULATE FULL HEIGHT OF INTERIOR BASEMENT WALL W/ MIN. R12 (RST 2.11) 51 STUD WALL REINFORCEMENT:

-WALL STUDS ADJACENT TO WATER CLOSETS & SHOWER BATH TUBS IN MAIN BATHROOM ARE TO BE REINFORCED TO PERMIT THE FUTURE INSTALLATION OF GRAB BARS AS PER O.B.C. 3.8.3.8.(3)(q)&(c) & 3.8.3.13.(2)(f) & 3.8.3.13.(4)(c) -GRAB BARS TO BE INSTALLED AS PER O.B.C. 9.8.7.7.(2) FRAME CONSTRUCTION: -ALL FRAMING LUMBER TO BE No. 1 AND No. 2 SPF UNLESS NOTED

-ROOF LOADING IS BASED ON 1.5kPa SPECIFIED COMPOSITE SNOW AND KAIN LOADS.

JOISTS TO HAVE MIN. 1-1/2" (38mm) END BEARING

-BEAN'S TO HAVE MIN. 3-1/2" (89mm) END BEARING

-DOUBLE STUDS @ OPENINGS

-DOUBLE HEADER JOISTS AROUND FLOOR OPENINGS WHEN THEY ARE BETWEEN 3'-11" (1200mm) AND 10'-6" (3200mm) -Double trimmer Joists when header Joist Length is between 2'-7"

(800mm) AND 6'-7" (2000mm)
-DOUBLE JOISTS OR SOLID BLOCKING UNDER NON-LOAD BEARING PARALLEL PARTITIONS -BEAMS TO BE PLACED UNDER LOADBEARING WALLS WHEN WALLS ARE -DEAMS TO SEP FOCED UNDER TOADBEARING WALLS WHEN WALLS AND PARALLEL TO FLOOR JOSTS -BEAMS MAY BE A MAX. 24" (600mm). FROM LOADBEARING WALLS WHEN WALLS ARE PERPENDICULAR TO FLOOR JOISTS -APPROVED METAL HANGERS TO BE USED FOR JOISTS AND BEAMS WHEN THEY FRAME INTO SIDES OF BEAMS, TRIMMERS AND HEADERS -FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED MORE THAN 15 3/4" (400mm) BEYOND SUPPORTS FOR 2" X 8" (38mm X

-FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED

WINDOWS: -WINDOWS TO BE SEALED TO THE AIR & VAPOR BARRIER -WINDOWS THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF AN ENERGY RATING OF NOT LESS THAN 21 FOR OPERABLE WINDOWS & 31 FOR FIXED WINDOWS OF THE WINDOWS WITH LOAD BEARING STRUCTURAL FRAME SHALL BE DOUBLE GLAZED WITH LOW-E COATING SKYLIGHTS SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF

FOR GROSS GLAZED AREAS LESS THAN 17%

ADDITIONAL COMPLIANCE ALTERNATIVES FOR PACKAGE J. -THE MINIMUM R (RSI) VALUE FOR THERMAL INSULATION IN EXPOSED ABOVE GRADE WALLS IS PERMITTED TO BE NO LESS THAN R20 (RSI 3.52) PROVIDED: AT THE WINDOWS AND SLIDING GLASS DOORS HAVE A MAXIMUM U-VALUE OF 1.6. OR THE THERMAL INSULATION VALUE IN BASEMENT WALLS HAS A

AINIMUM R20 (RSI 3.52). MULEDE BLOWN IN INCITA BLOOD OD VADOS AND ED BLOWN MUSICIFATION IS 1999 THE MINIMUM R (RSI) VALUE FOR THERMAL INSULATION IN EXPOSED ABOVE GRADE WALLS IS PERMITTED TO BE NO LESS THAN R20 (RSI 3.52) PROVIDED

a) THE THERMAL INSULATION VALUE IN A CEILING WITH AN ATTIC SPACE IS NOT LESS THAN R60 (RSI 10.55), b) THE MINIMUM EFFICIENCY OF THE HRV IS INCREASED BY NOT LESS THAN 8 PERCENTAGE POINTS.

9) THE MINIMUM **AFUE** OF THE SPACE HEATING EQUIPMENT IS INCREASED BY NOT LESS THAN 2 PERCENTAGE POINTS,

4) THE MINIMUM **EF** OF THE DOMESTIC HOT WATER HEATER IS INCREASED BY NOT LESS THAN 4 PERCENTAGE POINTS.

**OUENT SPECIFIC REVISIONS** 

Areas:

	ELEVATION 'A'		ELEVATION 'A' W/ 5 BEDROOMS		ELEVATION 'B'		ELEVATION 'B' W/ 5 BEDROOMS	
	SF	SM	SF	SM	SF	SM	SF	SM
GROUND FLOOR PLAN	1482.8	137.8	1482.8	137.8	1482.8	137.8	1482.8	137.8
SECOND FLOOR PLAN	1805.1	167.7	1805.1	167.7	1812.8	168.4	1812.8	168.4
TOTAL AREA	3287.9	305.4	3287.9	305.4	3295.6	306.2	3295.6	306.2
COVERAGE INC PORCH	1956.7	181.8	1956.7	181.8	1932.0	179.5	1932.0	179.5
COVERAGE NOT INC PORCH	1871.5	173.9	1871.5	173.9	1871.5	173.9	1871.5	173.9

RN design Imagine - Inspire - Create



I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD, UNDER DIVISION C, PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: FIRM BCIN:

SIGNATURE

TITLE SHEET BASEMENT FLOOR PLAN ELEV. 'A' GROUND FLOOR PLAN ELEV. 'A' SECOND FLOOR PLAN FLEV 'A'

OPT SECOND FLOOR ELEV 'A' W/ 5 BEDROOMS PART. BASEMENT FLOOR PLAN ELEV. 'B' PART, GROUND FLOOR PLAN ELEV, '8' PART. SECOND FLOOR PLAN ELEV. 'B' PART. OPT SECOND FLOOR ELEV 'B' W/ 5 BEDROOMS

PART, BSMT, FLR. PLAN EL. 'A'/'B' - OPT, SUNK, MUDRM. FRONT ELEVATION 'A' RIGHT SIDE ELEVATION 'A' REAR ELEVATION 'A' & 'B'

YPICAL CROSS-SECTION LEFT SIDE ELEVATION 'A' FRONT ELEVATION 'B' RIGHT SIDE ELEVATION 'B'

) LEFT SIDE ELEVATION 'B' PARTIAL BASEMENT FLOOR PLAN ELEV. 'B' WOB CONDITION PARTIAL GROUND FLOOR PLAN ELEV. 'B' WOB CONDITION PARTIAL REAR FLEVATION 'B' WOB CONDITION

PARTIAL BASEMENT FLOOR PLAN ELEV. 'B' LOB CONDITION PARTIAL GROUND FLOOR PLAN ELEV. 'B' LOB CONDITION PARTIAL REAR FLEVATION 'B' LOB CONDITION

PARTIAL BASEMENT FLOOR ELEV 'B' UPGRADE PARTIAL GROUND FLOOR ELEV 'B' UPGRADE 4 PARTIAL SECOND FLOOR ELEV 'B' UPGRADE

5 FRONT ELEVATION 'B' UPGRADE RIGHT SIDE ELEVATION 'B' UPGRADE REAR ELEVATION 'B' UPGRADE

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN.


MAR-23-15 RPA CR REVISED AS PER FLOOR & TRUSSES COORD. 17-Jun-15 RPA DJH REMOVED FIREPLACE JOG PROJECTION ON SIDE 15-Dec-15 CR CR REVISED AS PER CLIENT COMMENTS 12/18/2015 CR CR ISSUED FOR PERMIT 24-FE8-16 JP JP ADDED WOS AND LOS FOR REVIEW 29-APR-16 SM JM XX-XXX-XX SM IP REVISED PER ENG COMMENTS ADDED ELEV '6' CORNER UPGRADE 6-Jul-16 JR JS CO-ORD ELEV 'B' CORNER UPGRADE AS PER ROOF 24-Aug-16 PM ISSUED FOR PERMIT CORNER UPGRADE 7-SEPT-16 PM JM


> Gold Park Homes

**Huntington &** Nashville Kleinbura

42-3

14043 3/16" = 1'-0"

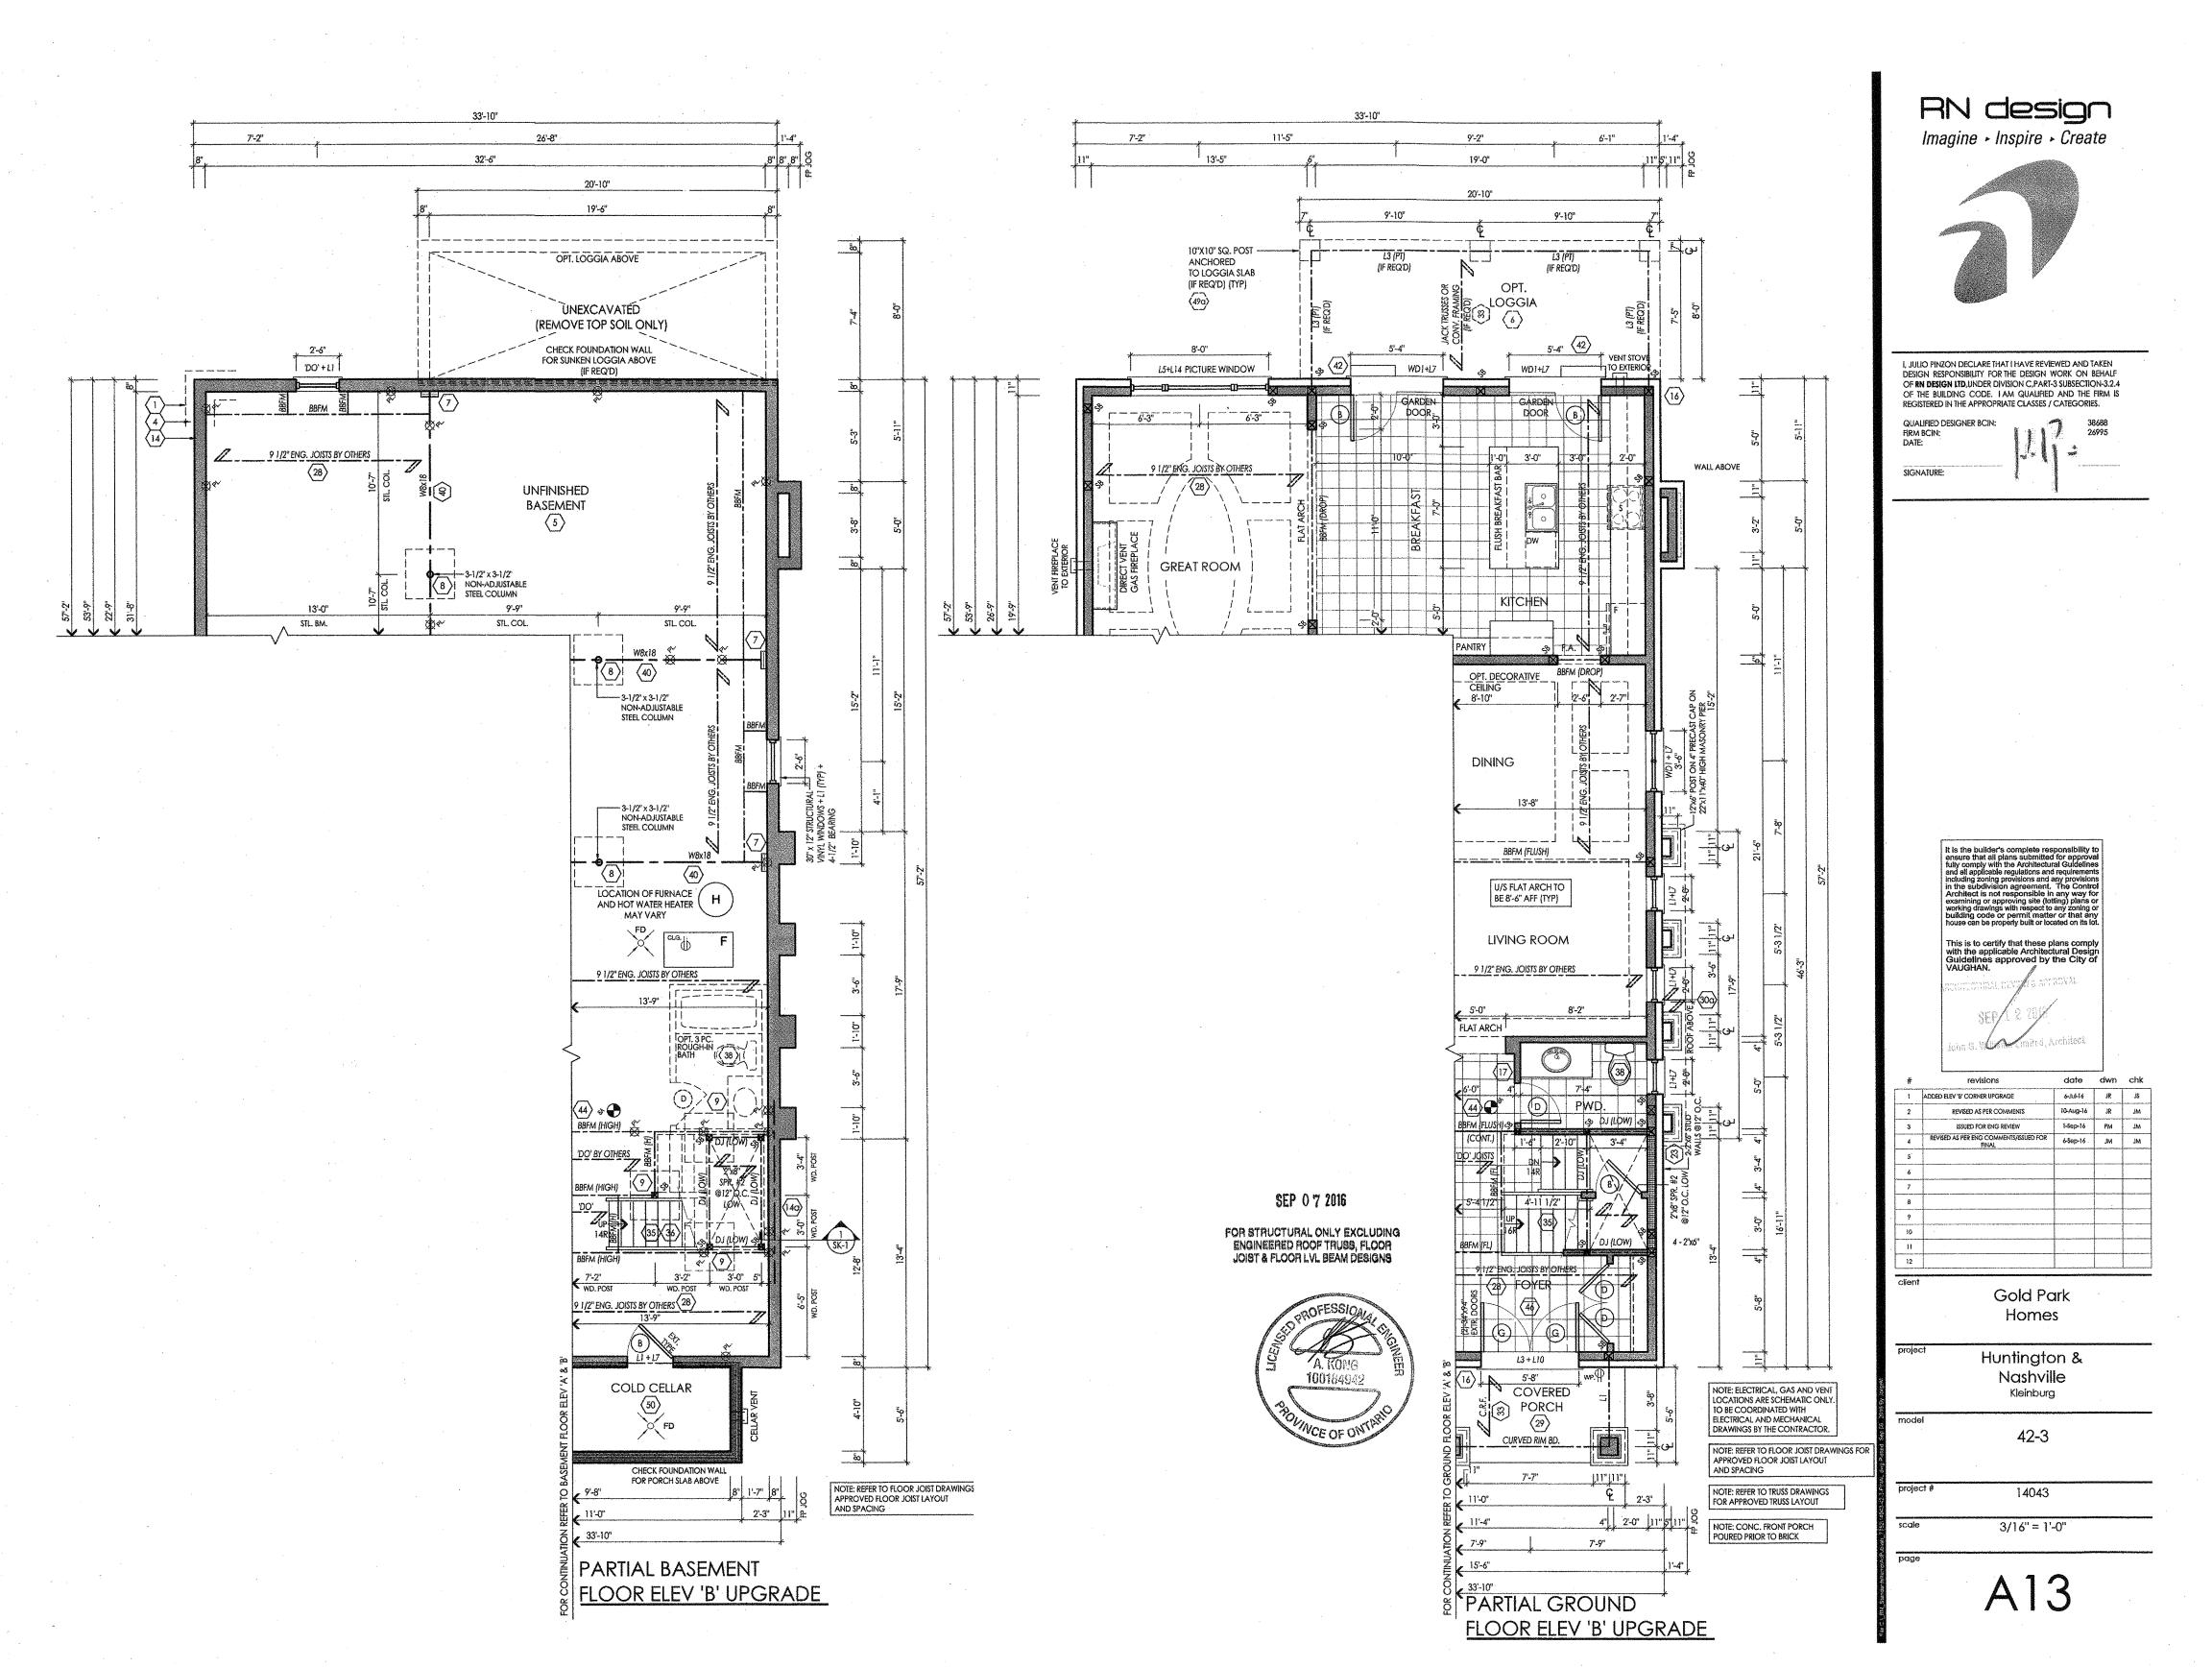

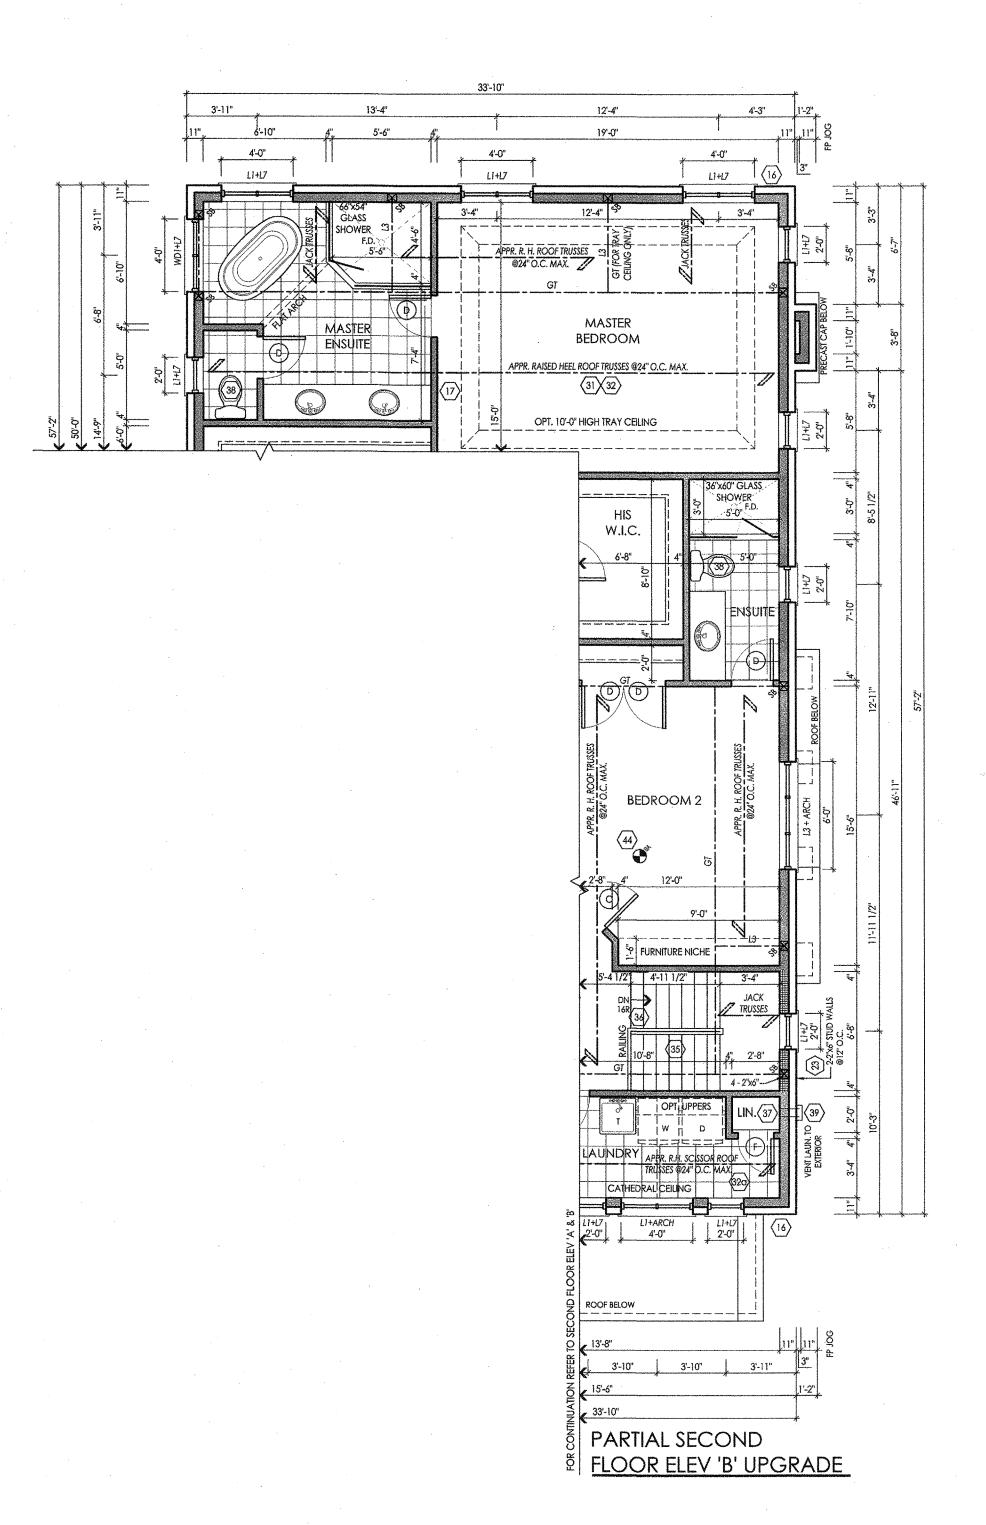



FOR STRUCTURAL ONLY EXCLUDING ENGINEERED ROOF TRUSS, FLOOR JOIST & FLOOR LVL BEAM DESIGNS



RN design

Imagine • Inspire • Create



I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF **RN DESIGN LTD.** UNDER DIVISION C.PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BC
FIRM BCIN;

SIGNATURE:

386 269

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zonling provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (totting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN.

Gold Park Homes

Huntington & Nashville Kleinburg

model


42-3

roject # 14043

scale 3/16" = 1'-0"

## GROSS GLAZING AREA

The state of the s	712.93 SF 344.93	n
· · · · · · · · · · · · · · · · · · ·	118.96 SF 11.05	
LEFT SIDE GLAZING AREA RIGHT SIDE GLAZING AREA	70.5 SF 6.55 143.89 SF 13.37	
	193.04 sf 17.93	
TOTAL GLAZING AREA TOTAL GLAZING PERCENTAGE	526.39 SF 48.90	'n

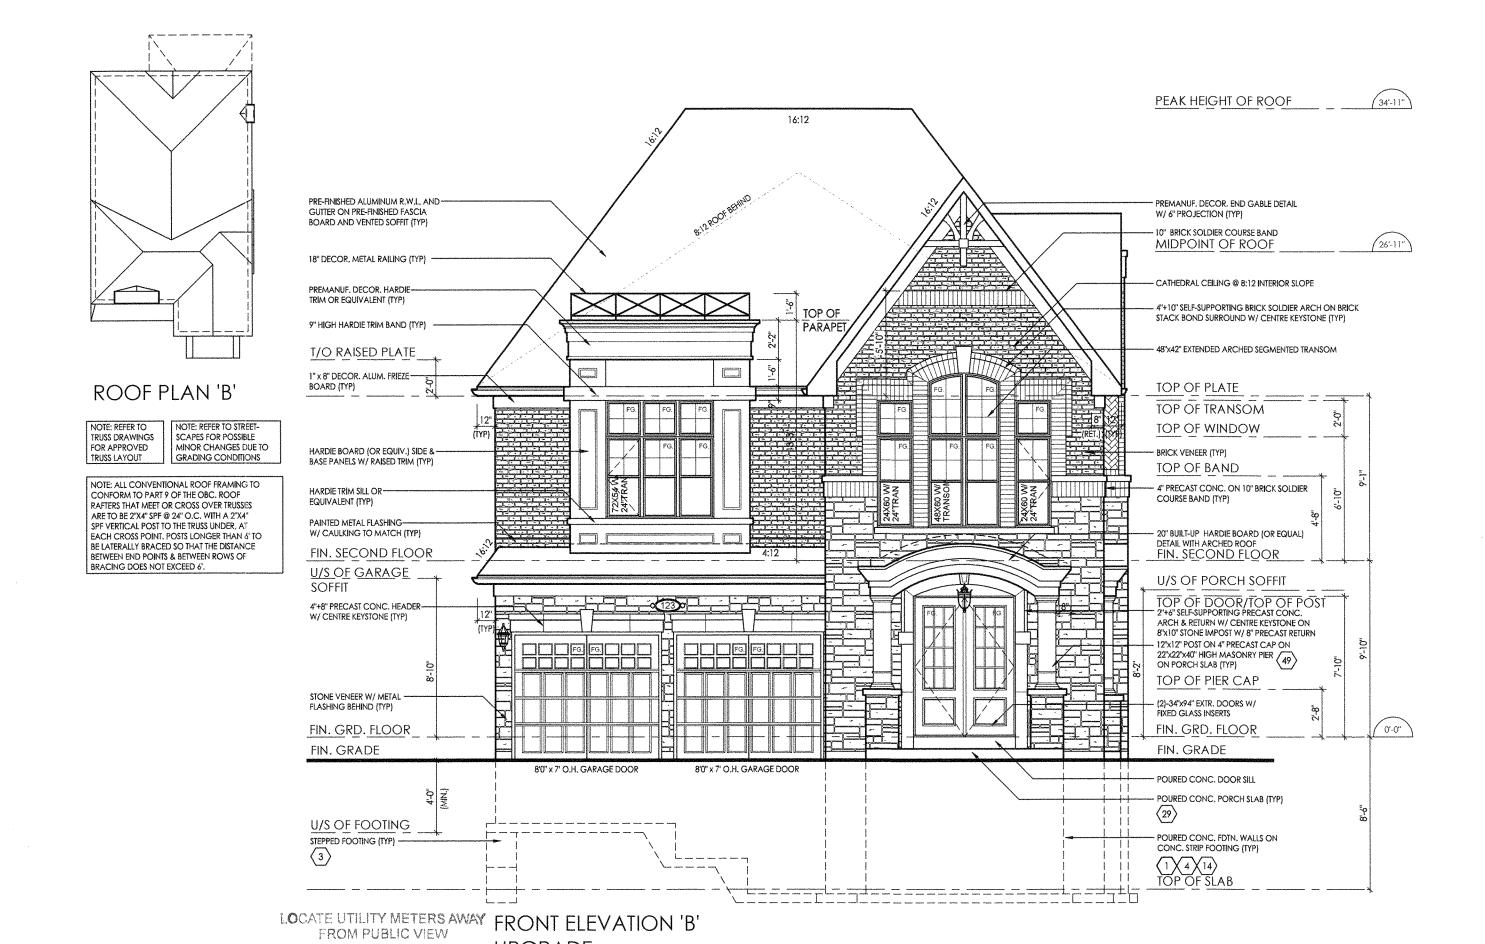

<u>UPGRADE</u>

RN design

Imagine - Inspire - Create




I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF **RN DESIGN LTD**, UNDER DIVISION C, PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: FIRM BCIN: DATE:

SIGNATURE:

38 26



#		revisions	date	dwn	chk
1	ADDED	ELEV 'B' CORNER UPGRADE	6-Jul-16	JR	.ZL
2		REVISED AS PER COMMENTS	10-Aug-16	JR	MĹ
3		ISSUED FOR ENG REVIEW	1-Sep-16	PM	ML
4		ISSUED FOR FINAL	6-Sep-16	JM	JM
5					
6					
7					
8					
9					
10					
11					
12					

Gold Park Homes

Huntington & Nashville Kleinburg


model

42-3

roject # 14043

ale 3/16" = 1'-0"

oage

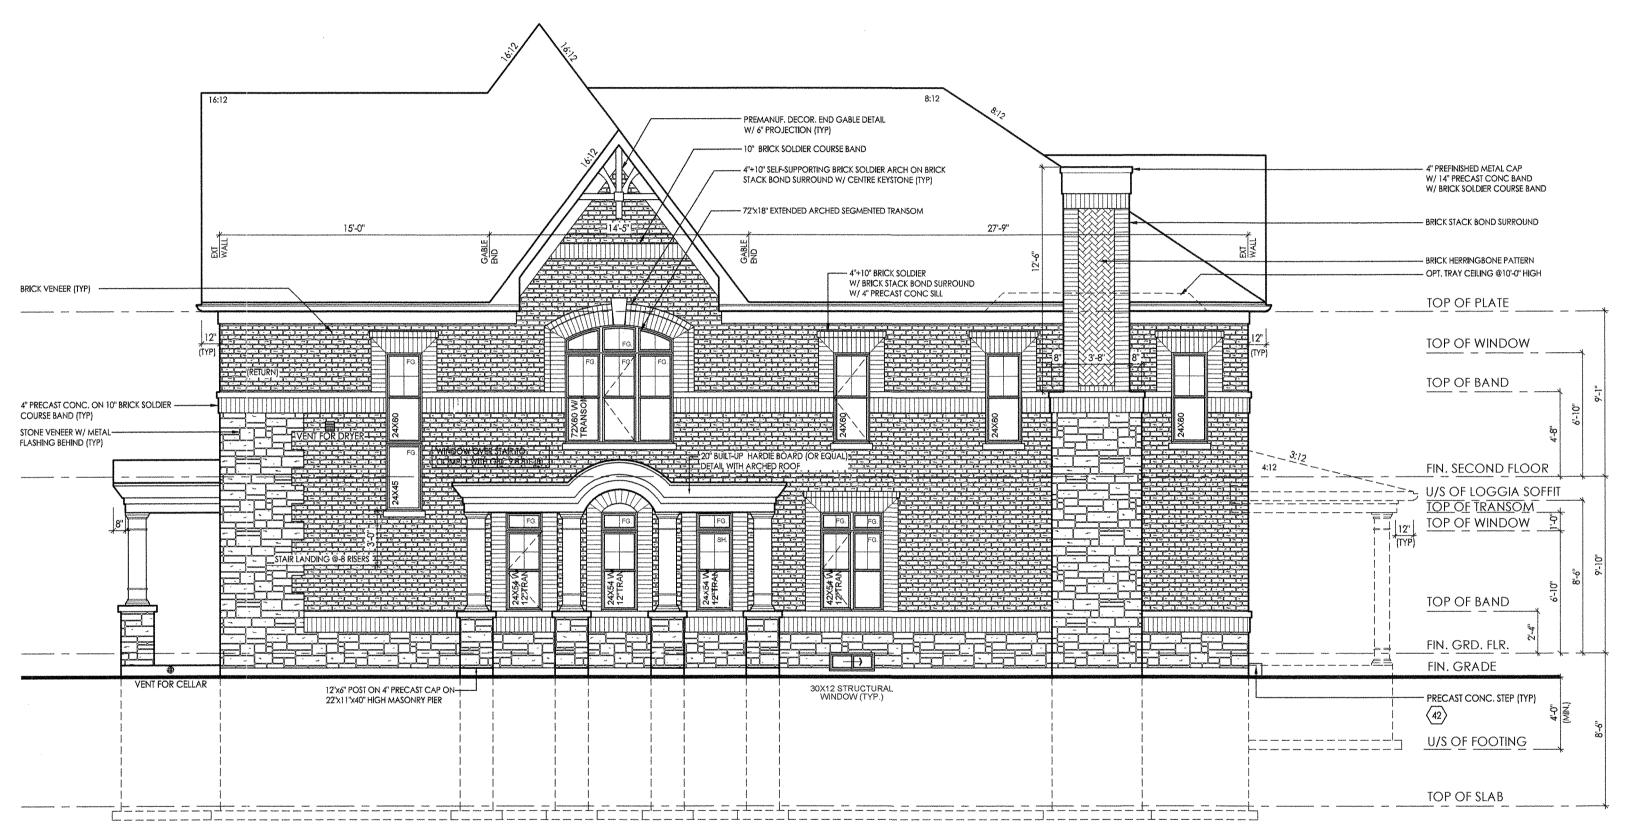

RIGHT SIDE ELEVATION 'B' <u>UPGRADE</u>

RN design

Imagine > Inspire > Create



I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF **RN DESIGN LTD.** UNDER DIVISION C.PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: FIRM BCIN:

SIGNATURE:

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot. This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN.

#	revisions	date	dwn	chk
1	ADDED ELEV 'B' CORNER UPGRADE	6-Jul-16	JR	JS
2	REVISED AS PER COMMENTS	10-Aug-16	JR	JM
3	ISSUED FOR ENG REVIEW	1-\$ep-16	РМ	ML
4	ISSUED FOR FINAL	6-Sep-16	ML	ML
5				
6				
7				
8				
9				
10				
11				
12				


Gold Park Homes

Huntington & Nashville Kleinburg

42-3

14043

3/16" = 1'-0"

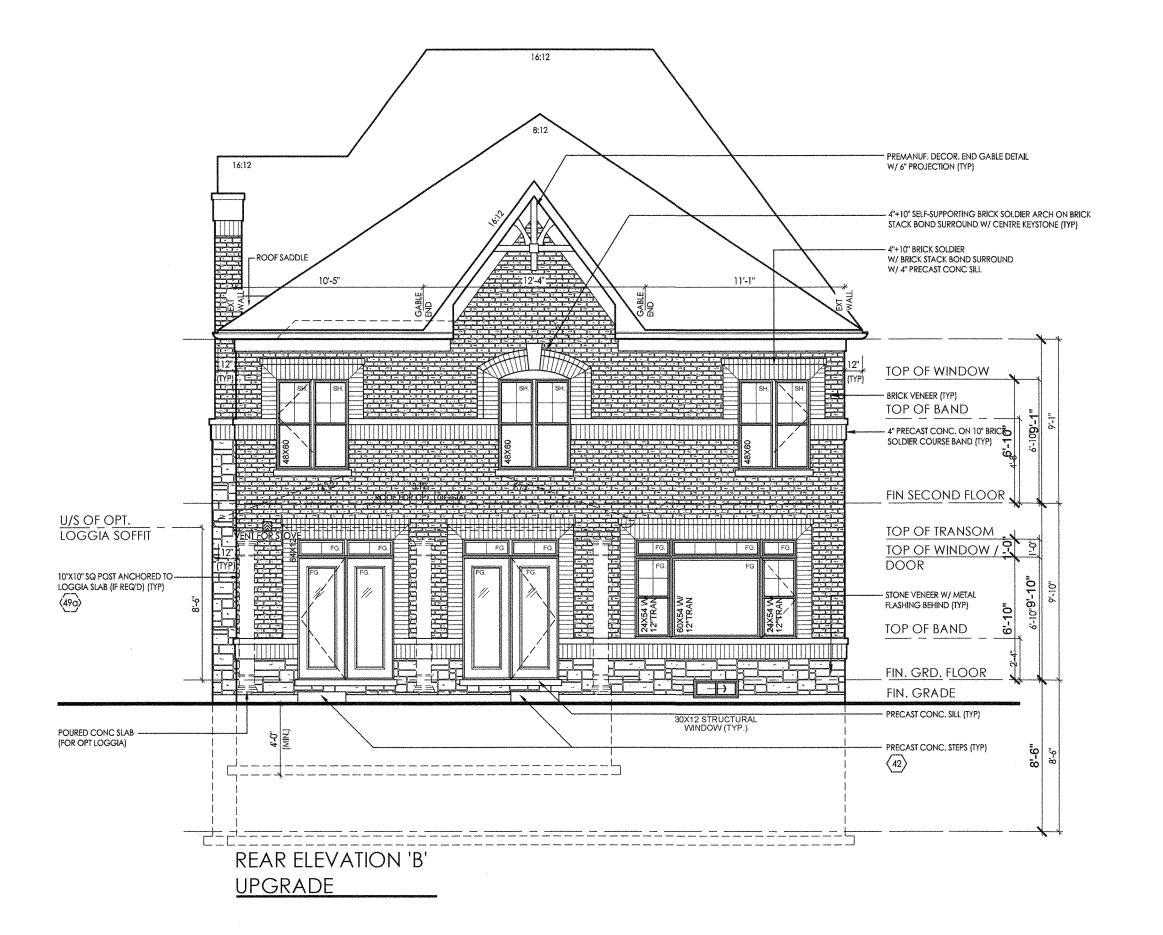

## RN design Imagine > Inspire > Create



I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD,UNDER DIVISION C.PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN:

SIGNATURE:

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot. This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN.

3. Williams Limited, Archite

#	revisions	date	dwn	chk
1	ADDED ELEV 'B' CORNER UPGRADE	6-Jul-16	JR	JS
2	REVISED AS PER COMMENTS	10-Aug-16	JR	ML
3	ISSUED FOR ENG REVIEW	1-Sep-16	PM	ML
4	ISSUED FOR FINAL	6-Sep-16	JM	ML
5				
6				
7				
8				
9				
10				
11				
12				

Homes

Huntington & Nashville Kleinburg

Gold Park

42-3

14043

3/16" = 1'-0"