

ENGINEERING NOTE PAGE (ENP-1) PLEASE READ PRIOR TO INSTALLATION

NEO818-069
GREENPARK - MINNISALE
HOMES - MILLWOOD 3 ELE 1

RESPONSIBILITIES

THIS DESIGN IS FOR AN INDIVIDUAL BUILDING COMPONENT AND HAS BEEN BASED ON INFORMATION PROVIDED BY THE DESIGN OFFICE OF KOTT LUMBER. THE UNDERSIGNED ENGINEER DISCLAIMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF FAULTY OR INCORRECT INFORMATION, SPECIFICATION AND/OR DESIGNS FURNISHED TO THE ENGINEER. THE UNDERSIGNED ENGINEER IS ONLY RESPONSIBLE FOR THE STRUCTURAL INTEGRITY OF THIS BUILDING COMPONENT FOR THE CONDITIONS AND LOADS SHOWN ON THIS DRAWING. THE STRUCTURAL INTEGRITY OF THE BUILDING AND THE VERIFICATION OF THE DIMENSIONS AND THE DESIGN LOADS USED ARE THE RESPONSIBILITY OF THE BUILDING DESIGNER.

TRUSSES ARE DESIGNED IN CONFORMANCE WITH THE RELEVANT SECTIONS OF THE NATIONAL BUILDING CODE OF CANADA OR THE CANADIAN CODE FOR FARM BUILDINGS, WHICHEVER APPLIES TO THE BUILDING TYPE INDICATED ON THE DRAWING

IT IS THE RESPONSIBILITY OF KOTT LUMBER TO ENSURE THAT TRUSSES ARE MANUFACTURED IN CONFORMANCE WITH THESE DESIGNS AND WITH THE SPECIFICATIONS OUTLINED BELOW. THE UNDERSIGNED ENGINEER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

USE AND OCCUPANCY

- The building is of the type indicated on the drawing

LOADING

- The truss loading intensity and distribution as well as load transfer mechanism is that indicated on the drawing
- No buildings, trees, parapets or other projections higher than the roof for which the trusses are used are located within a distance less than ten (10) times the difference in height, or five metres (16 ft) whichever is greater, unless the drawing indicates that the snow drifting has been taken into account

HANDLING, INSTALLATION AND BRACING

- The trusses must be handled and installed by a qualified professional as per the supplied document titled *Information for Truss Installers* and the BCSI-B1 and BCSI-B3 Summary Sheets
- The compression chords are laterally braced by continuous rigid diaphragm sheathing or as specified on the drawing
- Temporary and permanent bracing must be installed as indicated on the truss drawing and according to the BCSI-B1 and BCSI-B3 Summary Sheets. Bracing for the lateral stability of the truss is to be provided by the building designer
- It is recommended that a Professional Engineer's advice be obtained for the bracing of trusses spanning more than 12.37m (40'-7")

SUPPORTS

- The trusses are to be supported at the bearing points indicated and anchored to the supports where considered necessary by the designer of the overall structure
- Bearing sizes shown are the minimum required to prevent crushing of the truss members and do not necessarily take into account stability of the overall building structure
- Elevation of bearings must be carefully checked and shimmed to alignment for solid bearings
- Adequate wood truss bearing is the responsibility of the building designer.

DIMENSIONS



- Geometry of the truss and dimensions indicated on the drawing are identical to those of the installed truss.



Layout based on plans provided by
VA3 DESIGN
Dated May 30/18

THIS CERTIFICATION IS FOR THE ENGINEERING REVIEW OF STRUCTURAL COMPONENTS SHOWN ON THIS DRAWING AND IS LIMITED TO THE COMPONENTS SUPPLIED BY KOTT LUMBER FOR THE LOADS AND CONDITIONS SHOWN ON THE CALCULATION PAGE OF EACH COMPONENT. THE PLACEMENT OF THESE COMPONENTS ON THIS LAYOUT IS SHOWN FOR REFERENCE ONLY. ROOF TRUSSES MUST BE INSTALLED ACCORDING TO MANUFACTURER'S GUIDELINES AT 24" C/C UNLESS NOTED OTHERWISE. CONVENTIONAL FRAMING SHOWN ON THE LAYOUT MUST BE DESIGNED AND APPROVED BY THE PROJECT ENGINEER. TEMPORARY AND PERMANENT BRACINGS OF THE ROOF AND BUILDING ARE THE RESPONSIBILITY OF THE PROJECT ENGINEER AND TO CONFORM TO BCSI GUIDELINES.

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

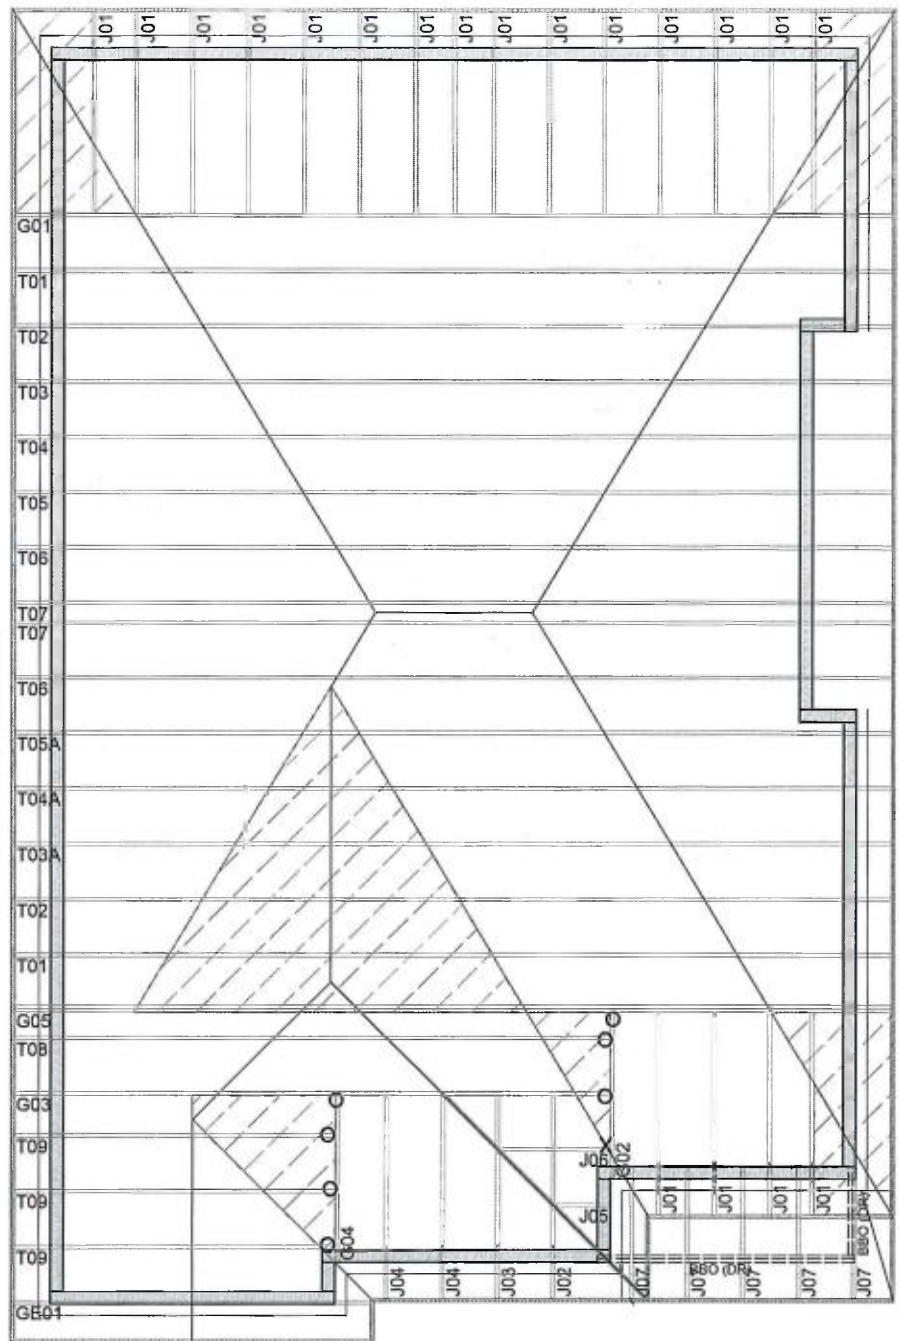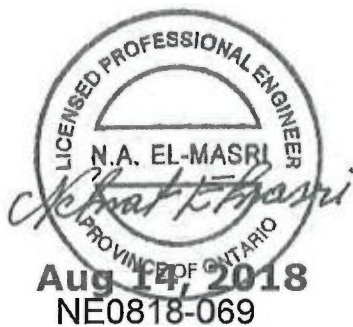

FLAT ROOF BELOW
BY OTHERS

ROOF TRUSS LAYOUT



CONVENTIONAL
FRAMING BY OTHERS

HANGER LEGEND

X - LUS24
- HGUS26

O - LJS26DS
% - HGUS26-2

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH LL = 23.3 psf
DL = 3.0 psf
BOT CH LL = 0.0 psf
DL = 7.0 psf
TOTAL LOAD = 33.3 psf


SPACING @ 24" CENTERS.
THIS TRUSS SYSTEM IS DESIGN FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBC 2010

THIS DESIGN COMPLIES WITH PART 9 OF OBC 2012,
BCBC 2012, ABC 2012, CSA 066-09, TPIC 2011
ALLOWABLE DEFLECTION OF EACH COMPONENT = L/360

Model:	MILLWOOD 3 EL 1
Customer:	GREENPARK
Project:	MINNISALE HOMES
Location:	BRAMPTON
Drawn By:	DM
Date:	6/25/2018

SIZE AND LOCATION OF CONVENTIONAL FRAMING IS APPROXIMATE. ALL AREAS MAY NOT BE SHOWN. REFER TO ARCHITECTURAL PLANS FOR DETAILS.

ALL CONVENTIONAL FRAMING TO CONFORM WITH PART 9 OF THE O.B.C RAFTER THAT CROSS MEET OVER TRUSSES TO BE 2X4 SPF @ 24" O/C WITH 2X4 VERT POST TO THE TRUSS BELOW EA CROSS PT. VERT POS. THAN 6" TO HAVE A LATERAL BRACING SO THAT THE DISTANCE BETEN PT & VERT ROWS OF BRACING DOES NOT EXCEED 6'

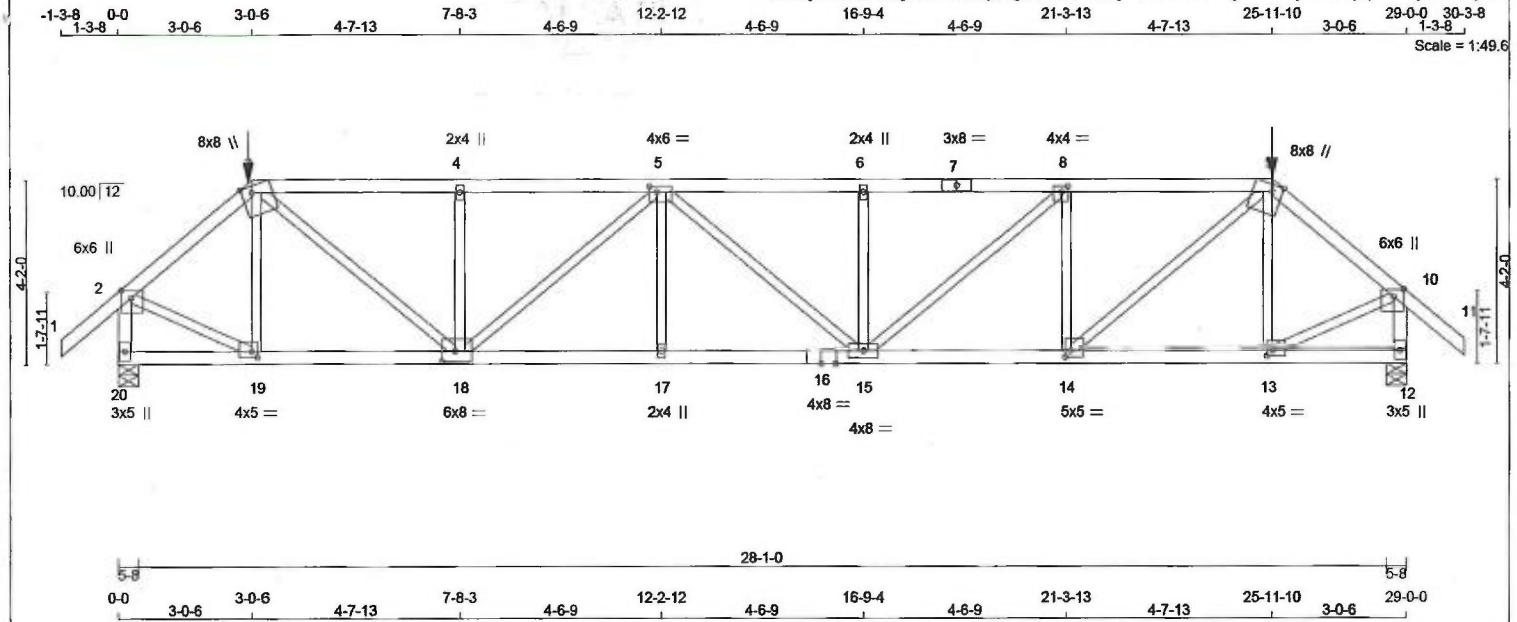

TOTAL WEIGHT = 121 lb

LUMBER

N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR.
1 - 3	2x4	DRY	No.2	SPF
3 - 7	2x4	DRY	No.2	SPF
7 - 9	2x4	DRY	No.2	SPF
9 - 11	2x4	DRY	No.2	SPF
20 - 2	2x4	DRY	No.2	SPF
12 - 10	2x4	DRY	No.2	SPF
20 - 16	2x4	DRY	No.2	SPF
16 - 12	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMVW+p	MT20	6.0	6.0	2.00	2.75
3	TTVW+m	MT20	8.0	8.0	Edge	2.75
4	TMW+w	MT20	2.0	4.0		
5	BMVWW-l	MT20	4.0	6.0	1.50	2.00
6	TMW+w	MT20	2.0	4.0		
7	TS-l	MT20	3.0	8.0		
8	BMWW-l	MT20	4.0	4.0	1.50	1.75
9	TTVW+m	MT20	8.0	8.0	Edge	2.75
10	TMVW+p	MT20	6.0	6.0	2.00	2.75
12	BMV1+p	MT20	3.0	5.0		
13	BMWW-l	MT20	4.0	5.0	1.50	1.50
14	BMWW-l	MT20	5.0	5.0	1.75	1.50
15	BMWWW-l	MT20	4.0	8.0		
16	BS-l	MT20	4.0	8.0		
17	BMW+w	MT20	2.0	4.0		
18	BMWWW-l	MT20	6.0	8.0	2.75	3.50
19	BMWW-l	MT20	4.0	5.0	1.50	1.50
20	BMV1+p	MT20	3.0	5.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

HANGERS NOTES



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BOILING BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
20	2669	0	2669	0	0	5-8	5-8
12	2669	0	2669	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
20	1871	1319 / 0	0 / 0	0 / 0	0 / 0	553 / 0	0 / 0
12	1871	1319 / 0	0 / 0	0 / 0	0 / 0	553 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 20, 12

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FR-TO		LENGTH	FR-TO			
1-2	0 / 34	-77.4	-77.4	0.12 (1)	10.00	19-3	-646 / 0	0.18 (1)
2-3	-2507 / 0	-77.4	-77.4	0.23 (1)	4.12	3-18	0 / 2621	0.65 (1)
3-4	-3920 / 0	-145.9	-145.9	0.80 (1)	2.72	18-4	-733 / 0	0.20 (1)
4-5	-3920 / 0	-145.9	-145.9	0.80 (1)	2.72	18-5	-1229 / 0	0.77 (1)
5-6	-4851 / 0	-145.9	-145.9	0.81 (1)	2.48	17-5	0 / 167	0.06 (4)
6-7	-4851 / 0	-145.9	-145.9	0.96 (1)	2.20	5-15	-6 / 0	0.00 (1)
7-8	-4851 / 0	-145.9	-145.9	0.96 (1)	2.20	15-6	-640 / 0	0.18 (1)
8-9	-3922 / 0	-145.9	-145.9	0.80 (1)	2.71	15-8	0 / 1220	0.30 (1)
9-10	-2507 / 0	-77.4	-77.4	0.23 (1)	4.12	18-4	-1528 / 0	0.42 (1)
10-11	0 / 34	-77.4	-77.4	0.12 (1)	10.00	14-9	0 / 2625	0.65 (1)
20-2	-2635 / 0	0.0	0.0	0.31 (1)	5.23	13-9	-648 / 0	0.18 (1)
12-10	-2635 / 0	0.0	0.0	0.31 (1)	5.23	2-19	0 / 2078	0.51 (1)
						13-10	0 / 2078	0.51 (1)
20-19	0 / 0	-33.0	-33.0	0.13 (4)	10.00			
19-18	0 / 1902	-33.0	-33.0	0.42 (1)	10.00			
18-17	0 / 4855	-33.0	-33.0	0.94 (1)	10.00			
17-16	0 / 4855	-33.0	-33.0	0.94 (1)	10.00			
16-15	0 / 4855	-33.0	-33.0	0.94 (1)	10.00			
15-14	0 / 3923	-33.0	-33.0	0.77 (1)	10.00			
14-13	0 / 1902	-33.0	-33.0	0.42 (1)	10.00			
13-12	0 / 0	-33.0	-33.0	0.13 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
3	3-0-6	-176	-176	--	BACK	VERT	TOTAL
9	25-11-10	-176	-176	--	BACK	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD		= 33.3	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHlp

GIRDER TYPE: CPrimeHlp
SIDE SETBACK = 3-0-6
END SETBACK = 6-0-0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO BACK SIDE
- ADD'L LOADS BASED ON 55 % OF GSL

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= $L/360$ (0.97")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.25")
ALLOWABLE DEFL.(TL)= $L/360$ (0.97")
CALCULATED VERT. DEFL.(TL) = $L/783$ (0.44")

CSI: TC=0.96/1.00 (6-8:1), BC=0.94/1.00 (15-17:1)
WB=0.77/1.00 (5-18:1), SS=0.35/1.00 (8-9:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PLI)		(PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	618	354	1667	822	2284 1656

CONTINUED ON PAGE 2



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
NE0818-069	G01	1	1	GREENPARK - MINNISALE HOMES MILLWOOD 3 ELE 1	PAGE 4 OF 40

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Aug 14 13:24:33 2018 Page 2
ID:luy2SMGWusilvMKN0qKdgz4O6R-YM8jzQZS2hXD8EYNYJEnyvdy?VpqsQQ2jUTc22ynx6

HANGERS NOTES

- 1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 175.9 lbs FACTORED DOWN AT 25-11-10, AND 175.9 lbs FACTORED DOWN AT 3-0-6 ON TOP CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (16) (INPUT = 0.90)

JSI METAL= 0.92 (16) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



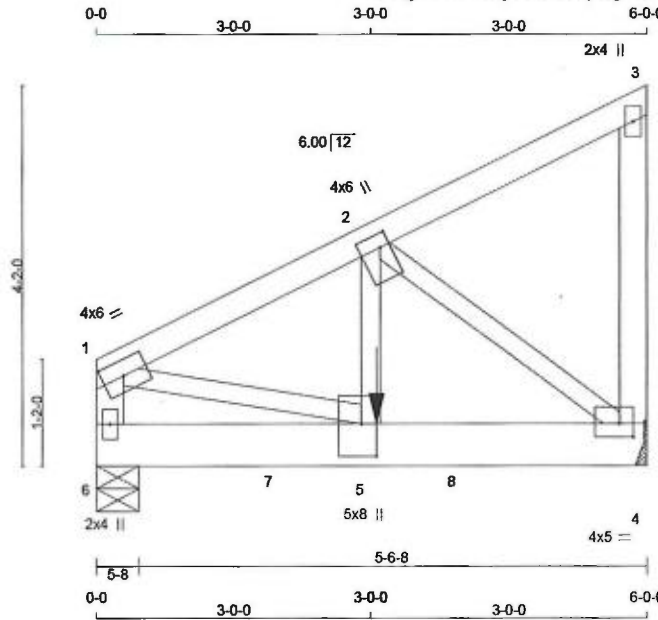

TOTAL WEIGHT = 29 lb

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
1 - 3	2x4	DRY	No.2
4 - 3	2x4	DRY	No.2
6 - 1	2x4	DRY	No.2
6 - 4	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
1	TMVW-1	MT20	4.0	6.0	2.00	2.75
2	TMVW+1	MT20	4.0	6.0	1.75	1.25
3	TMV+p	MT20	2.0	4.0		
4	BMVW1-1	MT20	4.0	5.0	1.75	1.75
5	BMVW+1	MT20	5.0	8.0	4.25	2.00
6	BMV1+p	MT20	2.0	4.0		

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 1872.3 lbs FACTORED DOWN AT 3'-0" ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
4	1952 0	1952 0	0	0
6	1519 0	1519 0	5-8	5-8

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT 4 TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN	COMPONENT REACTIONS
4	COMBINED	SNOW	LIVE PERM.LIVE WIND DEAD SOIL
4	1370	959 / 0	0 / 0 0 / 0 0 / 0 412 / 0 0 / 0
6	1066	746 / 0	0 / 0 0 / 0 0 / 0 320 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 6

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LC1 MAX (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
1-2	-1850 / 0	-77.4 -77.4	0.15 (1)	4.77	5-2	0 / 1826	0.45 (1)
2-3	-7 / 0	-77.4 -77.4	0.10 (1)	10.00	2-4	-2085 / 0	0.51 (1)
4-3	-100 / 0	0.0 0.0	0.03 (1)	7.81	1-5	0 / 1716	0.42 (1)
6-1	-1359 / 0	0.0 0.0	0.15 (1)	6.93			
6-7	0 / 0	-112.4 -112.4	0.08 (1)	10.00			
7-5	0 / 0	-17.5 -17.5	0.08 (1)	10.00			
5-8	0 / 1661	-17.5 -17.5	0.51 (1)	10.00			
8-4	0 / 1661	-437.5 -437.5	0.51 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
5	3'-0"-12	-1872	-1872		BACK	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
DL = 3.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.0	PSF	
TOTAL LOAD = 33.3	PSF	

SPACING = 24.0 IN. C/C

GIRDER TYPE: CSldGirder
START DISTANCE = 4'-0"
START SPAN CARRIED = 20'-2"
END DISTANCE = 6'-0"
END SPAN CARRIED = 20'-2"
END WALL WIDTH = 5'-8"
APPLIED TO FRONT SIDE OF BOTTOM CHORD.
- ADDTL LOADS BASED ON 55 % OF GSL.

GIRDER TYPE: CSldGirder
START DISTANCE = 0'-0"
START SPAN CARRIED = 6'-0"
END DISTANCE = 2'-0"
END SPAN CARRIED = 6'-0"
END WALL WIDTH = 0'-0"
APPLIED TO BACK SIDE OF BOTTOM CHORD.
- ADDTL LOADS BASED ON 55 % OF GSL.

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.15/1.00 (1-6:1), BC=0.51/1.00 (4-5:1), WB=0.51/1.00 (2-4:1), SSI=0.39/1.00 (4-5:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (1) (INPUT = 0.90)
JSI METAL= 0.57 (2) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



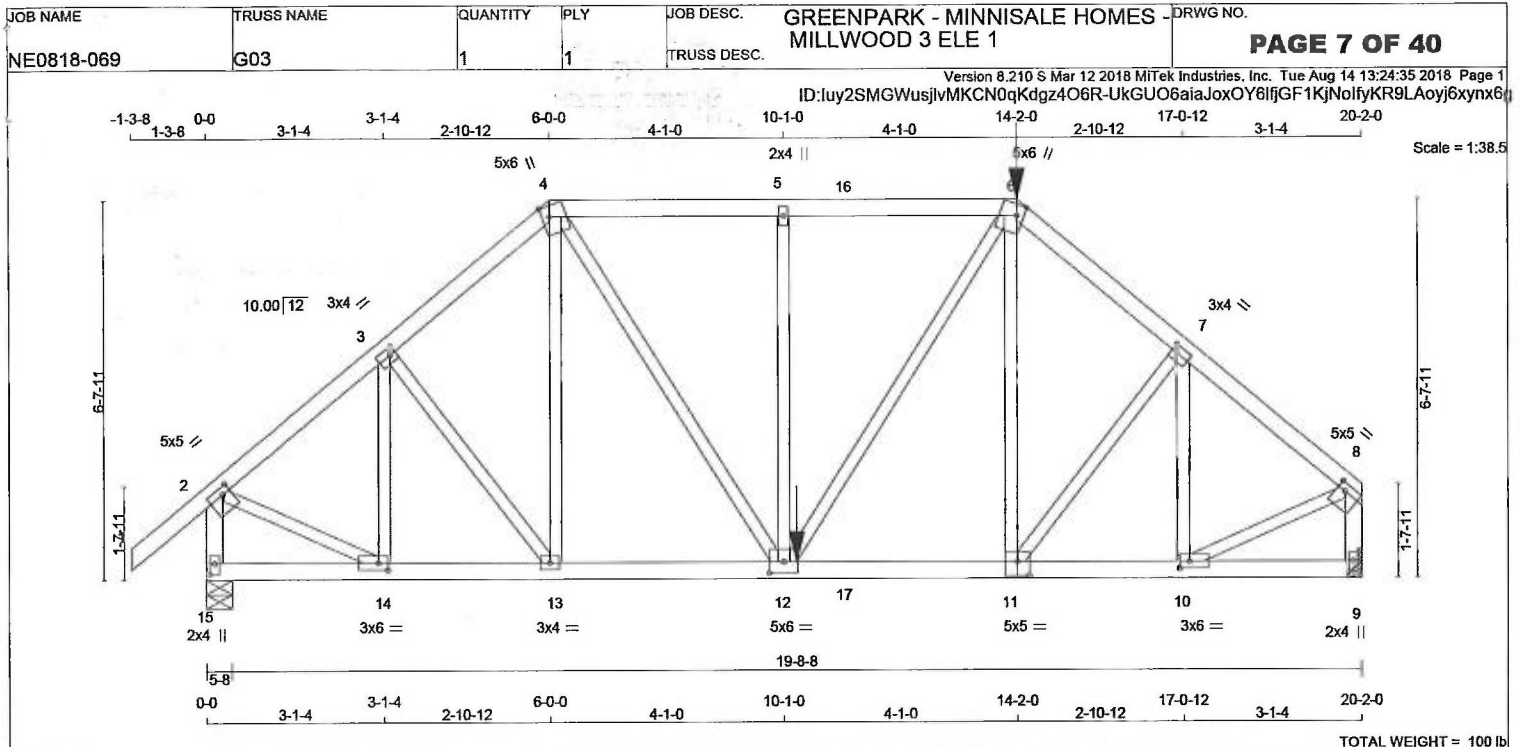

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
1 - 4	2x4	DRY	No.2 SPF
4 - 6	2x4	DRY	No.2 SPF
6 - 8	2x4	DRY	No.2 SPF
15 - 2	2x4	DRY	No.2 SPF
9 - 8	2x4	DRY	No.2 SPF
15 - 11	2x4	DRY	No.2 SPF
11 - 9	2x4	DRY	No.2 SPF

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMVW-t	MT20	5.0	5.0	1.50	1.75
3	TMWW-t	MT20	3.0	4.0	1.50	1.25
4	TTWW+m	MT20	5.0	6.0	2.25	1.50
5	TMW+w	MT20	2.0	4.0		
6	TTWW+m	MT20	5.0	6.0	2.25	1.50
7	TMWW-t	MT20	3.0	4.0	1.50	1.25
8	TMVW-t	MT20	5.0	5.0	1.50	1.75
9	BMV1+p	MT20	2.0	4.0	2.25	1.00
10	BMWW-t	MT20	3.0	6.0	1.50	2.00
11	BSWW-t	MT20	5.0	5.0	3.00	2.50
12	BMWWW-t	MT20	5.0	6.0	2.25	3.00
13	BMWW-t	MT20	3.0	4.0		
14	BMWW-t	MT20	3.0	6.0	1.50	2.00
15	BMV1+p	MT20	2.0	4.0	2.25	1.00

HANGERS NOTES

- SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 348.1 lbs FACTORED DOWN AT 14-2-0 ON TOP CHORD, AND 862.1 lbs FACTORED DOWN AT 10-3-12 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX		
15	1706	0	1706	0	0	5-8	5-8	
9	1869	0	1869	0	0	MECHANICAL		

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT 9 TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM. LIVE	WIND			
15	1194	854 / 0	0 / 0	0 / 0	340 / 0	0 / 0	0 / 0
9	1314	906 / 0	0 / 0	0 / 0	408 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 15

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.53 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	MAX. FACTORED CSI (LC)
FR-TO				FR-TO			
1-2	0 / 34	-77.4	-77.4 0.12 (1)	10-00	14-3	-449 / 0	0.13 (1)
2-3	-1518 / 0	-77.4	-77.4 0.15 (1)	5.16	3-13	0 / 121	0.03 (1)
3-4	-1652 / 0	-77.4	-77.4 0.16 (1)	4.99	13-4	-22 / 37	0.02 (1)
4-5	-1812 / 0	-77.4	-77.4 0.35 (1)	4.54	4-12	0 / 1034	0.26 (1)
5-16	-1812 / 0	-77.4	-77.4 0.36 (1)	4.53	12-5	-466 / 0	0.35 (1)
16-6	-1812 / 0	-145.9	-145.9 0.36 (1)	4.53	12-6	0 / 636	0.16 (1)
6-7	-1932 / 0	-77.4	-77.4 0.17 (1)	4.67	11-6	0 / 118	0.05 (4)
7-8	-1778 / 0	-77.4	-77.4 0.16 (1)	4.84	11-7	0 / 146	0.04 (1)
15-2	-1679 / 0	0.0	0.0 0.20 (1)	6.36	10-7	-482 / 0	0.14 (1)
9-8	-1823 / 0	0.0	0.0 0.21 (1)	6.15	2-14	0 / 1277	0.32 (1)
					10-8	0 / 1494	0.37 (1)
15-14	0 / 0	-17.5	-17.5 0.04 (4)	10.00			
14-13	0 / 1178	-17.5	-17.5 0.25 (1)	10.00			
13-12	0 / 1251	-17.5	-17.5 0.26 (1)	10.00			
12-17	0 / 1467	-17.5	-17.5 0.32 (1)	10.00			
17-11	0 / 1467	-33.0	-33.0 0.32 (1)	10.00			
11-10	0 / 1377	-33.0	-33.0 0.30 (1)	10.00			
10-9	0 / 0	-33.0	-33.0 0.07 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE
6	14-2-0	-348	-348	FRONT	VERT	TOTAL
12	10-3-12	-862	-862	FRONT	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHip
SIDE SETBACK = 6-0-0
END SETBACK = 6-0-0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADDTL LOADS BASED ON 55 % OF GSL.
LOADS APPLIED TO FIRST 9-0-0 OF SPAN
MEASURED FROM THE RIGHT.

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.67")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.67")
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CSI: TC=0.36/1.00 (5-6-1), BC=0.32/1.00 (11-12-1), WB=0.37/1.00 (8-10-1), SSI=0.24/1.00 (5-6-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



ID:luy2SMGWusjlvMKCN0qKdgz4O6R-UkGUO6aiaJoxOY6lfjGF1KjNolfyKR9LAoyj6xynx6

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (7) (INPUT = 0.90)

JSI METAL= 0.56 (8) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



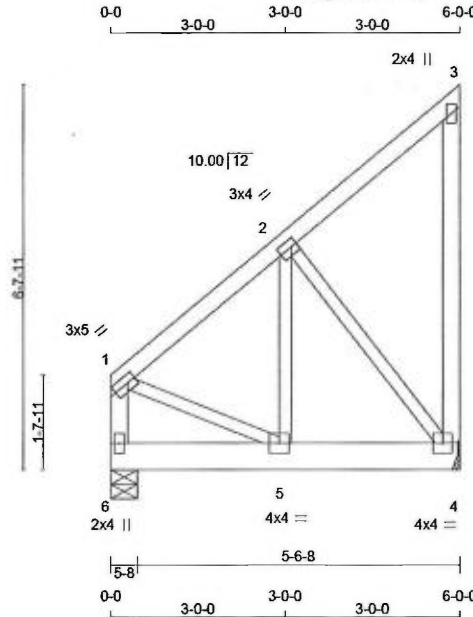

TOTAL WEIGHT = 36 lb [M]

LUMBER

N. L. G. A. RULES	SIZE	DRY	LUMBER	DESCR.
1 - 3	2x4	DRY	No.2	SPF
4 - 3	2x4	DRY	No.2	SPF
6 - 1	2x4	DRY	No.2	SPF
6 - 4	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
1	TMVW-1	MT20	3.0	5.0	1.50	1.75
2	TMWW-1	MT20	3.0	4.0	1.50	1.25
3	TMV+p	MT20	2.0	4.0		
4	BMVW1-t	MT20	4.0	4.0		
5	BMWW-t	MT20	4.0	4.0		
6	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
4	863 0	863 0	0 0	MECHANICAL
6	863 0	863 0	0 0	5-8

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT 4 TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
4	COMBINED	SNOW LIVE PERM.LIVE	0/0	182/0	0/0
6	COMBINED	SNOW LIVE PERM.LIVE	0/0	182/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 6

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	WEBS MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
1-2	-521/0	-77.4 -77.4	0.13 (1)	6.25	5-2	0/571	0.14 (1)
2-3	-17/0	-77.4 -77.4	0.12 (1)	6.25	2-4	-659/0	0.24 (1)
4-3	-89/0	0.0 0.0	0.07 (1)	7.81	1-5	0/446	0.11 (1)
6-1	-602/0	0.0 0.0	0.07 (1)	7.81			
6-5	0/0	-210.2 -210.2	0.12 (1)	10.00			
5-4	0/413	-210.2 -210.2	0.17 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3 PSF
DL = 3.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.0 PSF	
TOTAL LOAD = 33.3 PSF	

SPACING = 24.0 IN. C/C

GIRDER TYPE: CSldGirder

START DISTANCE = 0-0

START SPAN CARRIED = 10-3-0

END DISTANCE = 6-0-0

END SPAN CARRIED = 10-3-0

END WALL WIDTH = 1-8

APPLIED TO BACK SIDE OF BOTTOM CHORD.

- ADDTL LOADS BASED ON 55% OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")

CALCULATED VERT. DEFL.(LL) = L/999 (0.01")

ALLOWABLE DEFL.(TL) = L/360 (0.20")

CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.13/1.00 (1-2:1), BC=0.17/1.00 (4-5:1), WB=0.24/1.00 (2-4:1), SSI=0.25/1.00 (5-6:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP(DRY) SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667	822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

CONTINUED ON PAGE 2




READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



JSI GRIP= 0.89 (2) (INPUT = 0.90)
JSI METAL= 0.19 (5) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



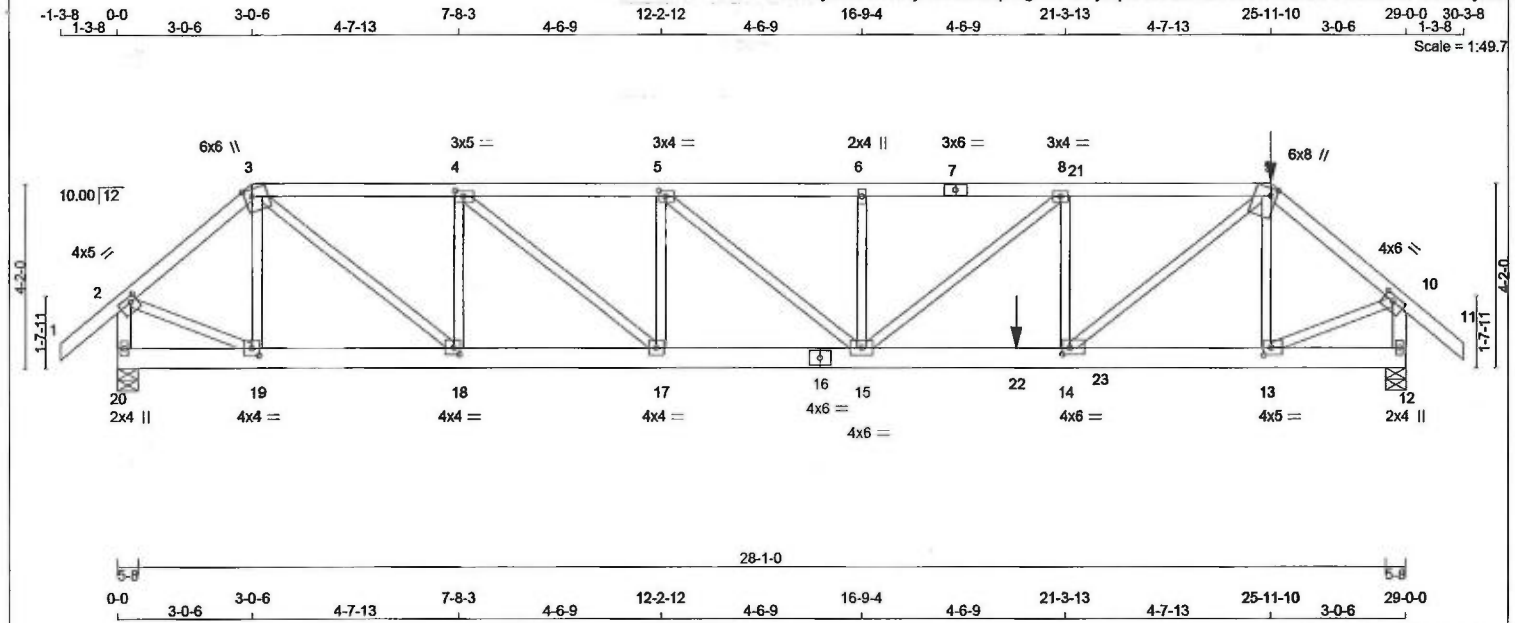

TOTAL WEIGHT = 2 X 138 = 276 lb [M]

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES				
1 - 3	2x4	DRY	No.2	SPF
3 - 7	2x4	DRY	No.2	SPF
7 - 9	2x4	DRY	No.2	SPF
9 - 11	2x4	DRY	No.2	SPF
20 - 2	2x4	DRY	No.2	SPF
12 - 10	2x4	DRY	No.2	SPF
20 - 16	2x6	DRY	No.2	SPF
16 - 12	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
1-3	12	TOP
3-7	12	TOP
7-9	12	SIDE(34.2)
9-11	12	SIDE(0.0)
20-2	12	TOP
12-10	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
20-16	12	TOP
16-12	12	SIDE(8.7)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQRD
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	BRG	BRG
20	2173	0		2173	0	5-8	5-8
12	3384	0		3384	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX./MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
20	1523	1080 / 0	0 / 0	0 / 0	0 / 0	443 / 0	0 / 0
12	2374	1669 / 0	0 / 0	0 / 0	0 / 0	704 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 20, 12

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.81 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
1-2	0 / 34	-77.4 -77.4 0.06 (1)	10.00	19-3	-515 / 0	0.07 (1)	
2-3	-2059 / 0	-77.4 -77.4 0.08 (1)	6.07	3-18	0 / 2475	0.31 (1)	
3-4	-3484 / 0	-77.4 -77.4 0.18 (1)	4.87	18-4	-1470 / 0	0.19 (1)	
4-5	-4789 / 0	-77.4 -77.4 0.23 (1)	4.24	4-17	0 / 1700	0.21 (1)	
5-6	-5707 / 0	-77.4 -77.4 0.24 (1)	3.93	17-5	-1119 / 0	0.15 (1)	
6-7	-5707 / 0	-77.4 -77.4 0.33 (1)	3.82	5-15	0 / 1195	0.15 (1)	
7-21	-5707 / 0	-77.4 -77.4 0.33 (1)	3.82	15-6	-307 / 0	0.04 (1)	
21-8	-5707 / 0	-145.9 -145.9 0.33 (1)	3.82	15-8	0 / 184	0.02 (1)	
8-9	-5566 / 0	-145.9 -145.9 0.38 (1)	3.81	14-8	-712 / 0	0.09 (1)	
9-10	-3281 / 0	-77.4 -77.4 0.11 (1)	5.06	14-9	0 / 3968	0.49 (1)	
10-11	0 / 34	-77.4 -77.4 0.06 (1)	10.00	13-9	-998 / 0	0.13 (1)	
20-2	-2163 / 0	0.0 0.0 0.12 (1)	7.56	2-19	0 / 1691	0.21 (1)	
12-10	-3314 / 0	0.0 0.0 0.19 (1)	6.39	13-10	0 / 2696	0.33 (1)	
20-19	0 / 0	-17.5 -17.5 0.02 (4)	10.00				
19-18	0 / 1562	-17.5 -17.5 0.12 (1)	10.00				
18-17	0 / 3484	-17.5 -17.5 0.27 (1)	10.00				
17-16	0 / 4789	-17.5 -17.5 0.41 (1)	10.00				
16-15	0 / 4789	-17.5 -17.5 0.41 (1)	10.00				
15-22	0 / 5566	-17.5 -17.5 0.80 (1)	10.00				
22-23	0 / 5566	-17.5 -17.5 0.80 (1)	10.00				
23-14	0 / 5566	-33.0 -33.0 0.80 (1)	10.00				
14-13	0 / 2484	-33.0 -33.0 0.35 (1)	10.00				
13-12	0 / 0	-33.0 -33.0 0.03 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
9	25-11-10	-176	-176	---	FRONT	VERT	TOTAL
22	20-2-12	-1952	-1952	---	FRONT	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	= 23.3 PSF
DL	= 3.0 PSF	
BOT CH.	LL	= 0.0 PSF
DL	= 7.0 PSF	
TOTAL LOAD	= 33.3 PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHlp
SIDE SETBACK = 3-0-6
END SETBACK = 6-0-0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADDTL LOADS BASED ON 55 % OF GSL.
LOADS APPLIED TO FIRST 8-0-0 OF SPAN MEASURED FROM THE RIGHT.

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.25")

CSI: TC=0.38/1.00 (8-9:1), BC=0.80/1.00 (14-15:1), WB=0.49/1.00 (9-14:1), SSI=0.53/1.00 (14-15:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMVW-t	MT20	4.0	5.0	1.50	1.75
3	TTWW+m	MT20	6.0	6.0	2.00	2.00
4	TMWW-t	MT20	3.0	5.0	1.50	2.25
5	TMWW-t	MT20	3.0	4.0	1.50	1.75
6	TMW+w	MT20	2.0	4.0		
7	TS-t	MT20	3.0	6.0		
8	TMWW-t	MT20	3.0	4.0		
9	TTWW+m	MT20	6.0	8.0	2.00	1.50
10	TMVW-t	MT20	4.0	6.0	1.50	2.75
12	BMV1+p	MT20	2.0	4.0		
13	BMWW-t	MT20	4.0	5.0	2.00	2.00
14	BMWW-t	MT20	4.0	6.0	1.75	2.00
15	BMWWWW-t	MT20	4.0	6.0		
16	BS-t	MT20	4.0	6.0		
17	BMWW-t	MT20	4.0	4.0		
18	BMWW-t	MT20	4.0	4.0	1.75	1.50
19	BMWW-t	MT20	4.0	4.0	2.00	1.75
20	BMV1+p	MT20	2.0	4.0		

HANGERS NOTES

- 1) SPECIAL HANGER(S) OR CONNECTION(S)
REQUIRED TO SUPPORT CONCENTRATED
LOAD(S) 175.9 lbs FACTORED DOWN AT
25-11-10 ON TOP CHORD, AND 1952.1 lbs
FACTORED DOWN AT 20-2-12 ON BOTTOM
CHORD. DESIGN FOR UNSPECIFIED
CONNECTION(S) IS DELEGATED TO THE
BUILDING DESIGNER.

TRUSS PLATE MANUFACTURER IS NOT
RESPONSIBLE FOR QUALITY CONTROL IN
THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.90 (9) (INPUT = 0.90)

JSI METAL= 0.55 (16) (INPUT = 1.00)

**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**




ID: Iuv2SMGWusilvMKCN0gKdaz4O6R-vxqsbSbKLcwp?hhxDRoUaXFcYi3v3vbVPShGfNynx6



TOTAL WEIGHT = 48 lb


KOTT

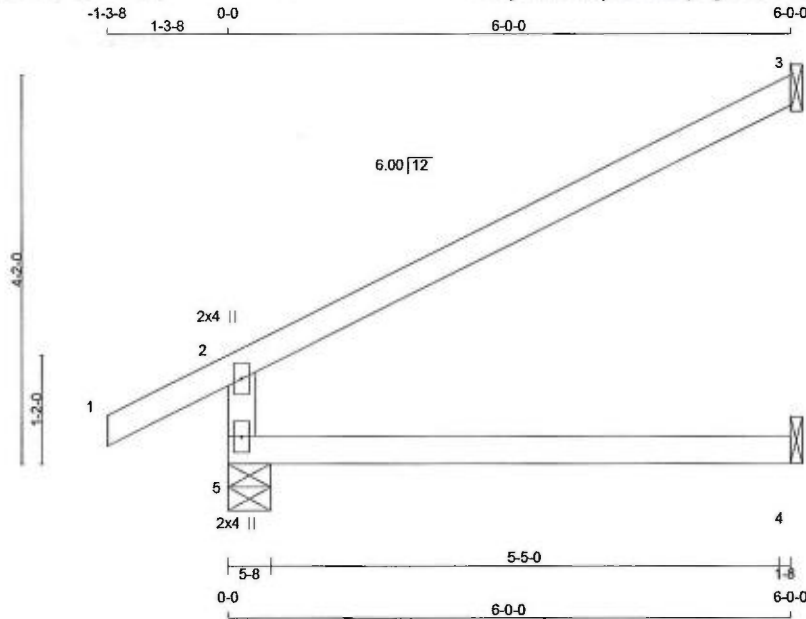

Scale = 1:23.6

TOTAL WEIGHT = 19 X 17 = 325 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
5 - 2	2x4	DRY	No.2	SPF	
1 - 3	2x4	DRY	No.2	SPF	
5 - 4	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMV+p	MT20	2.0	4.0		
5	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQRD BRG IN-SX	
	VERT	HORZ	DOWN	HORZ			
5	457	0	457	0	5-8	5-8	
3	174	0	174	0	1-8	1-8	
4	43	0	49	0	1-8	1-8	

SEE MITTEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) 3, 4

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS					SOIL
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	
5	318	238 / 0	0 / 0	0 / 0	0 / 0	80 / 0	0 / 0
3	118	105 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0
4	35	0 / 0	0 / 0	0 / 0	0 / 0	35 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 5

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		MEMB.	WEBS	
	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (PLF)	MAX. UNBRACED LENGTH		MAX. FORCE (LBS)	MAX. FACTORED (LC)
FR-TO		FROM	TO		FR-TO		
5-2	-395 / 0	0.0	0.0	0.13 (4)	7.81		
1-2	0 / 23	-77.4	-77.4	0.10 (1)	10.00		
2-3	-26 / 0	-77.4	-77.4	0.47 (1)	6.25		
5-4	0 / 0	-17.5	-17.5	0.13 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
DL =	3.0	PSF	
BOT CH.	LL =	0.0	PSF
DL =	7.0	PSF	
TOTAL LOAD =	33.3	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/999 (0.03")

CSI: TC=0.47/1.00 (2-3:1), BC=0.13/1.00 (4-5:4),
WB=0.00/1.00 (n/a:0), SSI=0.20/1.00 (2-3:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.23 (2) (INPUT = 0.90)
JSI METAL= 0.09 (2) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



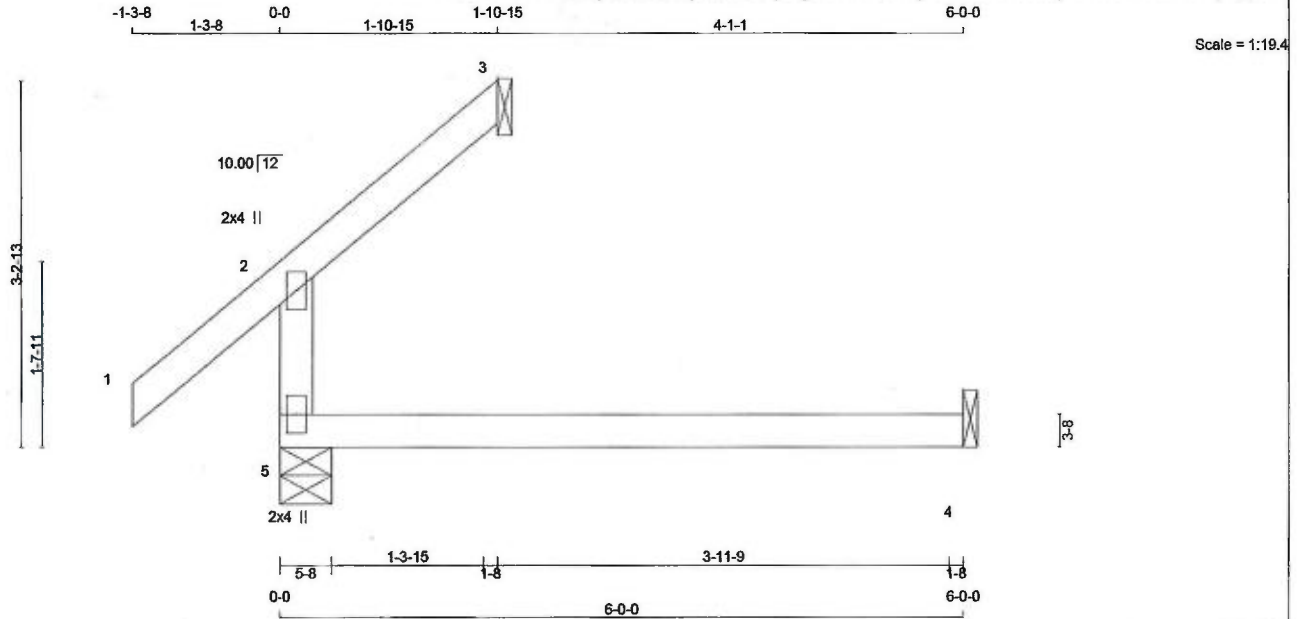

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
5 - 2	2x4	DRY	No.2	SPF	
1 - 3	2x4	DRY	No.2	SPF	
5 - 4	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMV+p	MT20	2.0	4.0		
5	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
5	256	0	256	0	5-8	5-8
3	59	0	59	0	1-8	1-8
4	45	0	52	0	1-8	1-8

SEE MITTEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) 3, 4

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
5	179	131 / 0	0 / 0	0 / 0	0 / 0	48 / 0	0 / 0
3	43	24 / 0	0 / 0	0 / 0	0 / 0	19 / 0	0 / 0
4	36	0 / -1	0 / 0	0 / 0	0 / 0	37 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 5, 3

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX CSJ (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSJ (LC)
FR-TO		FROM TO			FR-TO		
5-2	-196 / 0	0.0 0.0	0.09 (4)	7.81			
1-2	0 / 34	-77.4 -77.4	0.11 (1)	10.00			
2-3	-9 / 12	-77.4 -77.4	0.08 (4)	10.00			
5-4	0 / 0	-17.5 -17.5	0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
DL = 3.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.0	PSF	
TOTAL LOAD = 33.3	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/999 (0.04")

CSI: TC=0.11/1.00 (1-2:1), BC=0.14/1.00 (4-5:4), WB=0.00/1.00 (n/a:0), SSI=0.08/1.00 (4-5:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (2) (INPUT = 0.90)
JSI METAL= 0.05 (2) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



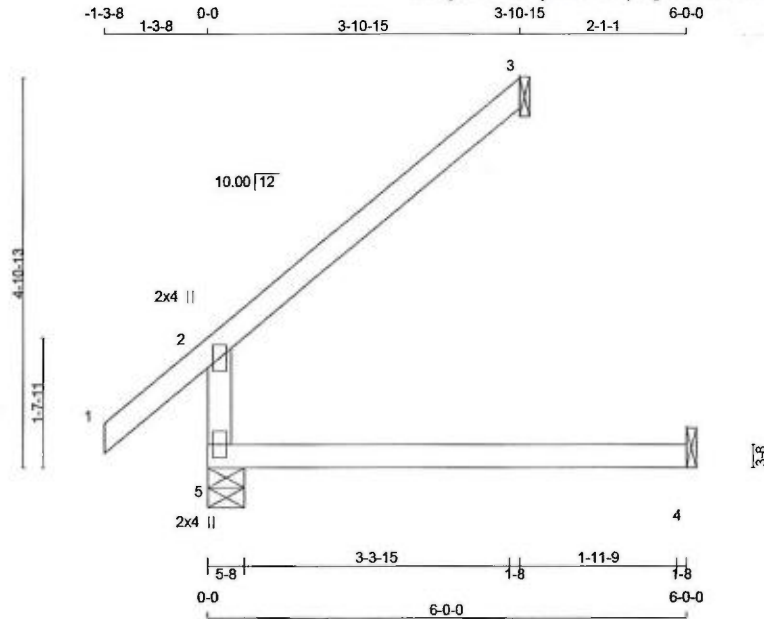

Scale = 1:27.7

TOTAL WEIGHT = 16 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
5 - 2	2x4	DRY	No.2	SPF	
1 - 3	2x4	DRY	No.2	SPF	
5 - 4	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMV+p	MT20	2.0	4.0		
5	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
5	357	0	357	0	0	5-8	5-8	
3	114	0	114	0	0	1-8	1-8	
4	45	0	50	0	0	1-8	1-8	

SEE MITTEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) 3, 4

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
5	250	178 / 0	0 / 0	0 / 0	0 / 0	71 / 0	0 / 0
3	77	68 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
4	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 5, 3

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	MEMB.
FR-TO					FR-TO			
5-2	-296 / 0	0.0	0.0	0.11 (4)	7.81			
1-2	0 / 34	-77.4	-77.4	0.11 (1)	10.00			
2-3	-24 / 0	-77.4	-77.4	0.20 (1)	6.25			
5-4	0 / 0	-17.5	-17.5	0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
DL =	3.0	PSF	
BOT CH.	LL =	0.0	PSF
DL =	7.0	PSF	
TOTAL LOAD =	33.3	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/999 (0.04")

CSI: TC=0.20/1.00 (2-3:1), BC=0.13/1.00 (4-5:4), WB=0.00/1.00 (n/a:0), SSI=0.11/1.00 (2-3:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.21 (2) (INPUT = 0.90)
JSI METAL= 0.08 (2) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



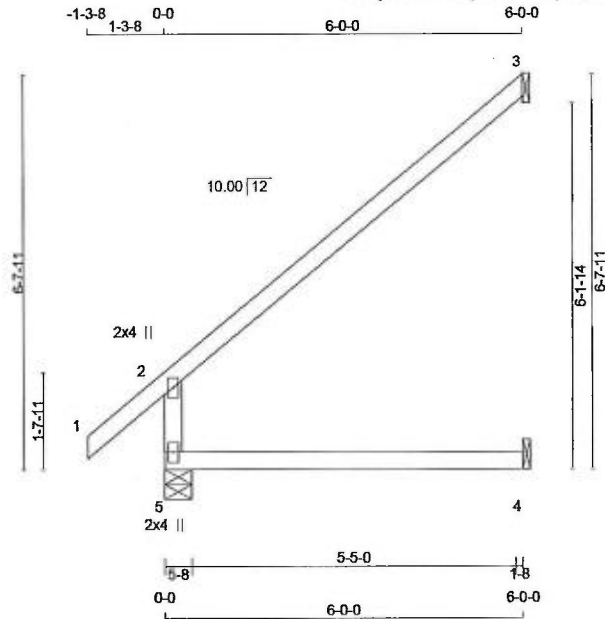

TOTAL WEIGHT = 2 X 19 = 39 lb

LUMBER				
N. L. G. A. RULES	SIZE	LUMBER	DESCR.	
CHORDS				
5 - 2	2x4	DRY	No.2	SPF
1 - 3	2x4	DRY	No.2	SPF
5 - 4	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
2	TMV+p	MT20	2.0	4.0	
5	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
5	458	0	458	0	5-8	5-8		
3	174	0	174	0	1-8	1-8		
4	45	0	50	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) 3, 4

UNFACTORED REACTIONS

JT	1ST LCASE		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
5	318	239 / 0	0 / 0	0 / 0	0 / 0	79 / 0	0 / 0
3	118	105 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0
4	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 5

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	FR-TO
5-2	-397 / 0	0.0	0.0 0.11 (4)	7.81			
1-2	0 / 34	-77.4	-77.4 0.11 (1)	10.00			
2-3	-37 / 0	-77.4	-77.4 0.48 (1)	6.25			
5-4	0 / 0	-17.5	-17.5 0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.48/1.00 (2-3:1), BC=0.13/1.00 (4-5:4), WB=0.00/1.00 (n/a:0), SSI=0.17/1.00 (2-3:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.29 (2) (INPUT = 0.90)
JSI METAL= 0.71 (2) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



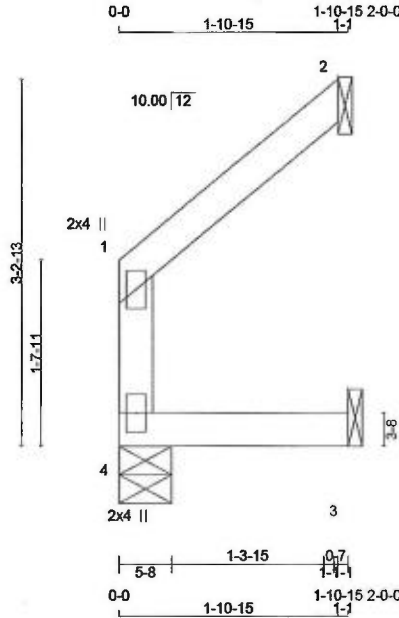

Scale = 1:19.4

TOTAL WEIGHT = 7 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
4 - 1	2x4	DRY	No.2	SPF
1 - 2	2x4	DRY	No.2	SPF
4 - 3	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
1	TMV+p	MT20	2.0	4.0		
4	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQRD BRG IN-SX	
	VERT	HORZ	DOWN	HORZ			
4	92	0	92	0	0	5-8	5-8
2	70	0	70	0	0	1-8	1-8
3	22	0	22	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) 2, 3

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
4	64	45/0	0/0	0/0	0/0	20/0	0/0
2	47	41/0	0/0	0/0	0/0	6/0	0/0
3	17	3/0	0/0	0/0	0/0	14/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 4, 2

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (PLF)	LC1 MAX (CSI (L))	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (L)	
FR-TO		FROM	TO			FR-TO			
4-1	-78 / 0	0.0	0.0	0.01 (1)	7.81				
1-2	-3 / 0	-77.4	-77.4	0.04 (1)	10.00				
4-3	0 / 0	-17.5	-17.5	0.02 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
DL =	3.0	PSF	
BOT CH.	LL =	0.0	PSF
DL =	7.0	PSF	
TOTAL LOAD =	33.3	PSF	

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/999 (0.00")

CSI: TC=0.04/1.00 (1-2:1), BC=0.02/1.00 (3-4:4), WB=0.00/1.00 (n/a:0), SSI=0.05/1.00 (1-2:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.06 (1) (INPUT = 0.90)
JSI METAL= 0.02 (1) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON
 ENGINEERING NOTE PAGE ENP-1. THIS
 NOTE PAGE IS AN INTEGRAL PART OF
 THIS DRAWING AS IT CONTAINS
 SPECIFICATIONS AND CRITERIA USED IN
 THE DESIGN OF THIS COMPONENT.



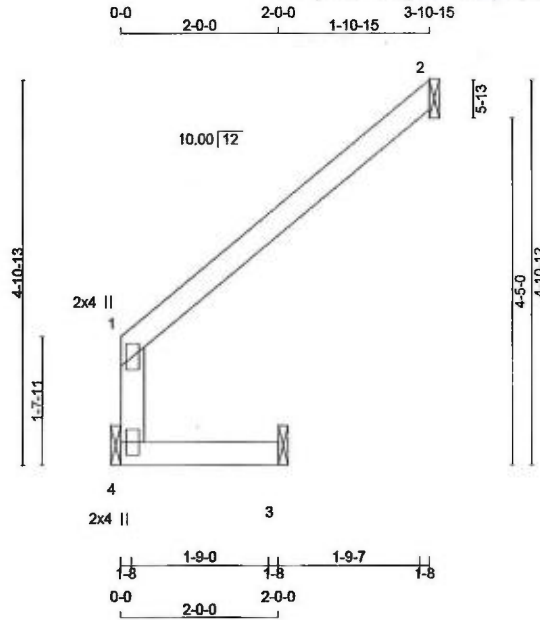

Scale = 1:28.0

TOTAL WEIGHT = 10 lb [M/JF]

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
4 - 1	2x4	DRY	No.2	SPF
1 - 2	2x4	DRY	No.2	SPF
4 - 3	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
1	TMV+p	MT20	2.0	4.0		
4	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
4	152	0	152	0	1-8	1-8	1-8	1-8
2	134	0	134	0	1-8	1-8	1-8	1-8
3	51	0	51	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) 4, 2, 3

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
4	106	81/0	0/0	0/0	0/0	25/0	0/0
2	91	81/0	0/0	0/0	0/0	11/0	0/0
3	37	21/0	0/0	0/0	0/0	16/0	0/0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

FR-TO	CHORDS			WEBS		
	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 MAX (PLF) CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH FR-TO (LC)
4-1		-168/0	0.0 0.0 0.08 (1)			7.81
1-2		-11/0	-77.4 -77.4 0.15 (1)			6.25
4-3		0/0	-17.5 -17.5 0.09 (1)			10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
DL = 3.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.0	PSF	
TOTAL LOAD = 33.3	PSF	

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/999 (0.00")

CSI: TC=0.15/1.00 (1-2:1), BC=0.09/1.00 (3-4:1), WB=0.00/1.00 (n/a:0), SSI=0.10/1.00 (1-2:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.12 (1) (INPUT = 0.90)
JSI METAL= 0.05 (1) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.





PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
2	TMV+p	MT20	2.0	4.0	
6	BMV+p	MT20	2.0	4.0	

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
3	114	0	114	0	0	1-8	1-8
4	7	0	27	0	0	1-8	1-8
5	321	0	321	0	0	3-0	3-0


1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
3	77	69 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
4	8	0 / -11	0 / 0	0 / 0	0 / 0	19 / 0	0 / 0
5	223	167 / 0	0 / 0	0 / 0	0 / 0	56 / 0	0 / 0

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MAX. UNBRAC. LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO		FR-TO		
6-2	-260 / 0	0.0	0.0	0.10 (1)	7.81		
1-2	0 / 21	-77.4	-77.4	0.05 (1)	10.00		
2-7	-20 / 0	-77.4	-77.4	0.19 (1)	6.25		
7-3	-20 / 0	-77.4	-77.4	0.19 (1)	6.25		
6-5	0 / 0	-17.5	-17.5	0.10 (1)	10.00		
5-4	0 / 0	-17.5	-17.5	0.10 (1)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

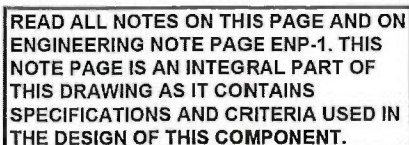

SPECIFIED LOADS:			
TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD		=	33.3 PSF

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT
OFF.

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.01")

CANTILEVER DEFLECTION:
ALLOWABLE DEFL.(LL)= $L/120$ (0.19")
CALCULATED VERT. DEFL(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL)= $L/120$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/927$ (0.01")

CSI: TC=0.19/1.00 (2-3:1), BC=0.10/1.00 (5-6:1),
WB=0.00/1.00 (n/a:0), SSI=0.21/1.00 (5-6:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

CONTINUED ON PAGE 2




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
NE0818-069	J07	5	1	GREENPARK - MINNISALE HOMES MILLWOOD 3 ELE 1	PAGE 21 OF 40
Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Aug 14 13:24:40 2018 Page 2 ID:luy2SMGWusjlvMKN0qKdgz4O6R-ri3NRqerPrQDUJ_jSHsQkNQHFJPY?n94K3fTo8ynx6b					


JSI GRIP= 0.17 (2) (INPUT = 0.90)
JSI METAL= 0.06 (2) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Aug 14 13:24:40 2018 Page 1
ID: Iuy2SMGWusjlvMKCN0qKdgz4O6R-ri3NRqerPrQDUJ_jSHsQkNQ9eJKp7iy4K3fTo8ynx6b
Scale = 1:49.7

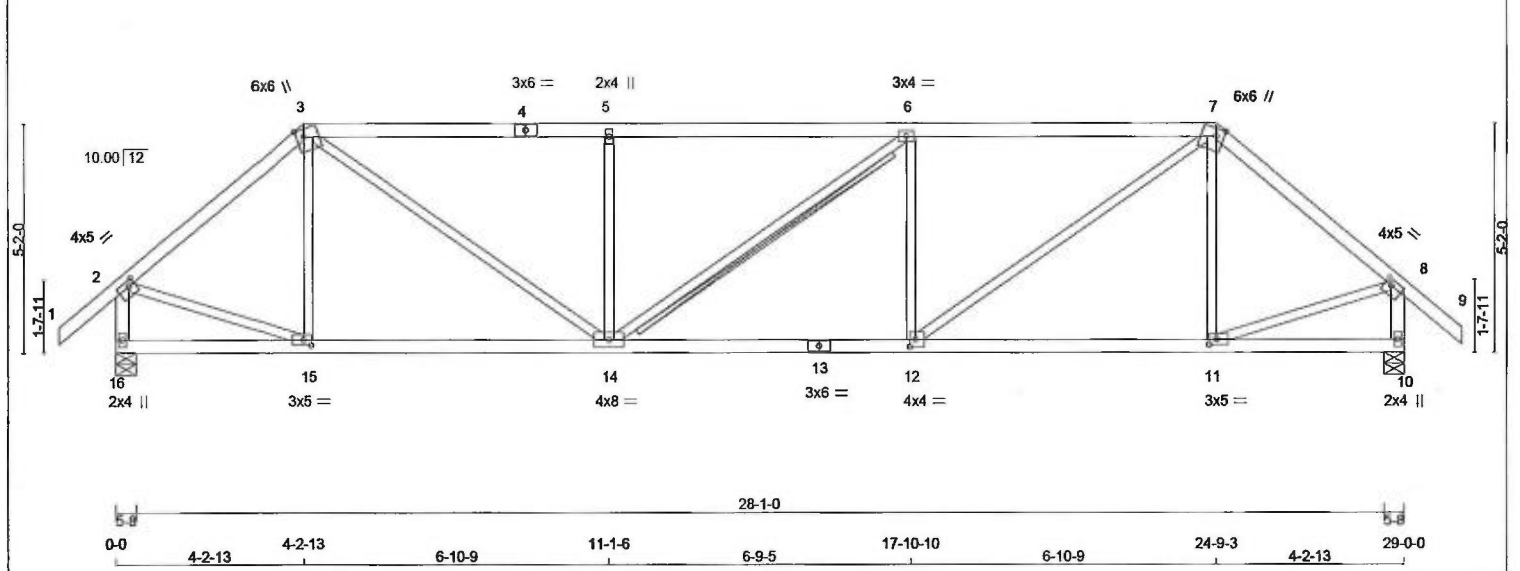

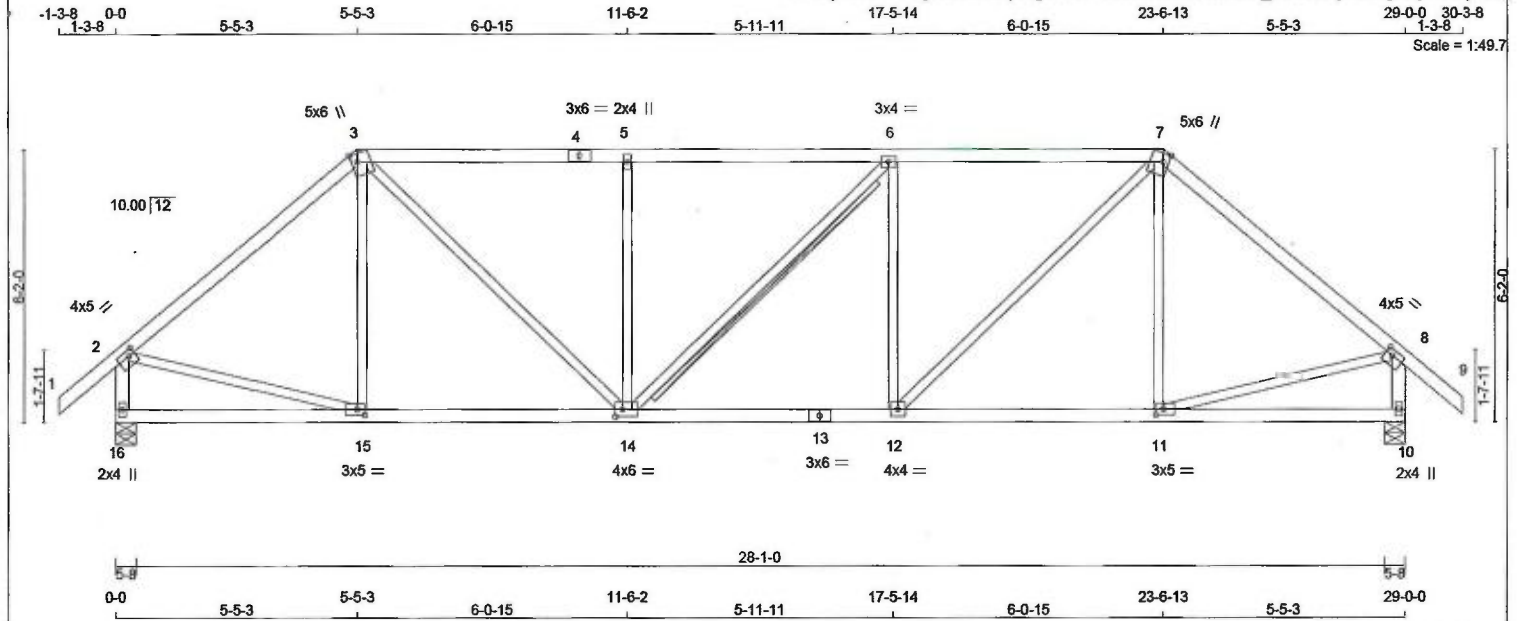

TOTAL WEIGHT = 2 X 123 = 247 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
1 - 3	2x4	DRY	No.2
3 - 4	2x4	DRY	No.2
4 - 7	2x4	DRY	No.2
7 - 9	2x4	DRY	No.2
16 - 2	2x4	DRY	No.2
10 - 8	2x4	DRY	No.2
16 - 13	2x4	DRY	No.2
13 - 10	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMVW-t	MT20	4.0	5.0	1.50	1.75
3	TTWW+m	MT20	5.0	6.0	2.25	1.50
4	TS-t	MT20	3.0	6.0		
5	TMW+w	MT20	2.0	4.0		
6	TMWW-t	MT20	3.0	4.0		
7	TTWW+m	MT20	5.0	6.0	2.25	1.50
8	TMVW-t	MT20	4.0	5.0	1.50	1.75
10	BMV1+p	MT20	2.0	4.0		
11	BMWW-t	MT20	3.0	5.0	1.50	2.00
12	BMWW-t	MT20	4.0	4.0		
13	BS-t	MT20	3.0	6.0		
14	BMWWW-t	MT20	4.0	6.0	2.00	2.00
15	BMWW-t	MT20	3.0	5.0	1.50	2.00
16	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	UPLIFT		
16	1483	0	1483	0	5-8	5-8
10	1483	0	1483	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE MAX./MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
16	1038	740 / 0	0 / 0	0 / 0	0 / 0	298 / 0	0 / 0
10	1038	740 / 0	0 / 0	0 / 0	0 / 0	298 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 16, 10

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.59 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT 6-14

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM	TO		FR-TO			
1-2	0 / 34	-77.4	-77.4	0.11 (1)	10.00	15-3	-133 / 52	0.08 (1)
2-3	-1371 / 0	-77.4	-77.4	0.49 (1)	4.97	3-14	0 / 873	0.20 (1)
3-4	-1678 / 0	-77.4	-77.4	0.46 (1)	4.61	14-5	-503 / 0	0.30 (1)
4-5	-1678 / 0	-77.4	-77.4	0.46 (1)	4.61	14-6	-3 / 0	0.00 (1)
5-6	-1678 / 0	-77.4	-77.4	0.47 (1)	4.60	12-6	-505 / 0	0.30 (1)
6-7	-1679 / 0	-77.4	-77.4	0.47 (1)	4.59	12-7	0 / 876	0.20 (1)
7-8	-1371 / 0	-77.4	-77.4	0.49 (1)	4.97	11-7	-134 / 52	0.08 (1)
8-9	0 / 34	-77.4	-77.4	0.11 (1)	10.00	2-15	0 / 1080	0.24 (1)
16-2	-1445 / 0	0.0	0.0	0.15 (1)	6.80	11-8	0 / 1080	0.24 (1)
10-8	-1445 / 0	0.0	0.0	0.15 (1)	6.80			
16-15	0 / 0	-17.5	-17.5	0.14 (4)	10.00			
15-14	0 / 1049	-17.5	-17.5	0.25 (1)	10.00			
14-13	0 / 1680	-17.5	-17.5	0.33 (1)	10.00			
13-12	0 / 1680	-17.5	-17.5	0.33 (1)	10.00			
12-11	0 / 1048	-17.5	-17.5	0.25 (1)	10.00			
11-10	0 / 0	-17.5	-17.5	0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL)= L/999 (0.07")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL)= L/999 (0.14")

CSI: TC=0.49/1.00 (2-3:1), BC=0.33/1.00 (12-14:1), WB=0.30/1.00 (6-12:1), SSJ=0.22/1.00 (6-7:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 Inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (12) (INPUT = 0.90)
JSI METAL= 0.47 (2) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



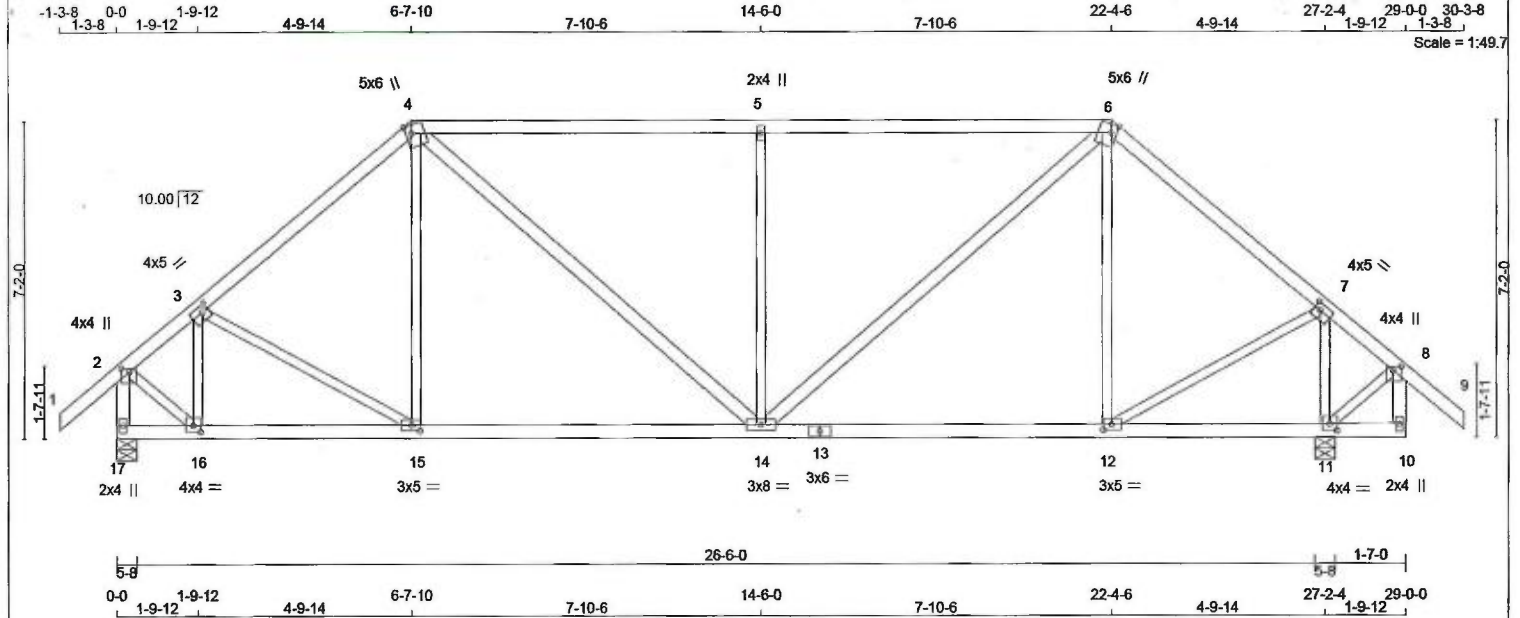

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
1 - 4	2x4	DRY	No.2 SPF
4 - 6	2x4	DRY	No.2 SPF
6 - 9	2x4	DRY	No.2 SPF
17 - 2	2x4	DRY	No.2 SPF
10 - 8	2x4	DRY	No.2 SPF
17 - 13	2x4	DRY	No.2 SPF
13 - 10	2x4	DRY	No.2 SPF
ALL WEBS EXCEPT	2x3	DRY	No.2 SPF
4 - 14	2x4	DRY	No.2 SPF
14 - 6	2x4	DRY	No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMVW+p	MT20	4.0	4.0	1.00	2.25
3	TMWW-I	MT20	4.0	5.0	1.75	1.75
4	TTWW+m	MT20	5.0	6.0	2.25	1.50
5	TMW+w	MT20	2.0	4.0		
6	TTWW+m	MT20	5.0	6.0	2.25	1.50
7	TMWW-I	MT20	4.0	5.0	1.75	1.75
8	TMVW+p	MT20	4.0	4.0	1.00	2.25
10	BMV+p	MT20	2.0	4.0		
11	BMWW-I	MT20	4.0	4.0	1.75	2.00
12	BMWW-I	MT20	3.0	5.0	1.50	2.25
13	BS-I	MT20	3.0	6.0		
14	BMWW-I	MT20	3.0	8.0		
15	BMWW-I	MT20	3.0	5.0	1.50	2.25
16	BMWW-I	MT20	4.0	4.0	1.75	2.00
17	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
17	1384	0	1384	0	5-8	5-8
11	1581	0	1581	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE MAX./MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
17	969	691 / 0	0 / 0	0 / 0	0 / 0	278 / 0	0 / 0
11	1107	789 / 0	0 / 0	0 / 0	0 / 0	318 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 17, 11

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.78 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH	MAX. FACTORED CSI (LC)
FR-TO		FROM TO		FR-TO			
1-2	0 / 34	-77.4 -77.4	0.11 (1)	10.00	16-3	-524 / 0	0.10 (1)
2-3	-1009 / 0	-77.4 -77.4	0.22 (1)	5.94	3-15	0 / 155	0.03 (1)
3-4	-1235 / 0	-77.4 -77.4	0.26 (1)	5.49	15-4	0 / 104	0.04 (4)
4-5	-1330 / 0	-77.4 -77.4	1.00 (1)	3.78	4-14	0 / 529	0.08 (1)
5-6	-1330 / 0	-77.4 -77.4	1.00 (1)	3.78	14-5	-751 / 0	0.67 (1)
6-7	-947 / 0	-77.4 -77.4	0.26 (1)	6.05	14-6	0 / 831	0.13 (1)
7-8	0 / 135	-77.4 -77.4	0.25 (1)	10.00	12-6	-337 / 0	0.30 (1)
8-9	0 / 34	-77.4 -77.4	0.11 (1)	10.00	12-7	0 / 907	0.20 (1)
17-2	-1371 / 0	0.0 0.0	0.15 (1)	6.94	11-7	-1451 / 0	0.27 (1)
10-8	-5 / 5	0.0 0.0	0.00 (4)	7.81	2-16	0 / 981	0.22 (1)
					11-8	-97 / 0	0.02 (1)
17-16	0 / 0	-17.5 -17.5	0.03 (4)	10.00			
16-15	0 / 796	-17.5 -17.5	0.22 (1)	10.00			
15-14	0 / 931	-17.5 -17.5	0.30 (4)	10.00			
14-13	0 / 704	-17.5 -17.5	0.28 (4)	10.00			
13-12	0 / 704	-17.5 -17.5	0.28 (4)	10.00			
12-11	-79 / 0	-17.5 -17.5	0.16 (4)	6.25			
11-10	0 / 0	-17.5 -17.5	0.05 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.91")
CALCULATED VERT. DEFL.(LL)= L/999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.91")
CALCULATED VERT. DEFL.(TL)= L/999 (0.11")

CANTILEVER DEFLECTION:
ALLOWABLE DEFL.(LL)= L/120 (0.19")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/120 (0.19")
CALCULATED VERT. DEFL.(TL)= L/999 (0.00")

CSI: TC=1.00/1.00 (4-5:1), BC=0.30/1.00 (14-15:4), WB=0.67/1.00 (5-14:1), SSI=0.30/1.00 (4-5:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667 822 2284 1656

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
NE0818-069	T03	1	1	GREENPARK - MINNISALE HOMES MILLWOOD 3 ELE 1	PAGE 25 OF 40
TRUSS DESC. Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Aug 14 13:24:42 2018 Page 2 ID:luy2SMGWusjlvMKN0gKdgz4O6R-n5B7sVg5wSgxc85aiuupoVQ672yTX9NnN8as1ynx6Z					

PLATE PLACEMENT TOL. = 0.250 inches
 PLATE ROTATION TOL. = 5.0 Deg.
 JSI GRIP= 0.89 (8) (INPUT = 0.90)
 JSI METAL= 0.37 (7) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
 ENGINEERING NOTE PAGE ENP-1. THIS
 NOTE PAGE IS AN INTEGRAL PART OF
 THIS DRAWING AS IT CONTAINS
 SPECIFICATIONS AND CRITERIA USED IN
 THE DESIGN OF THIS COMPONENT.



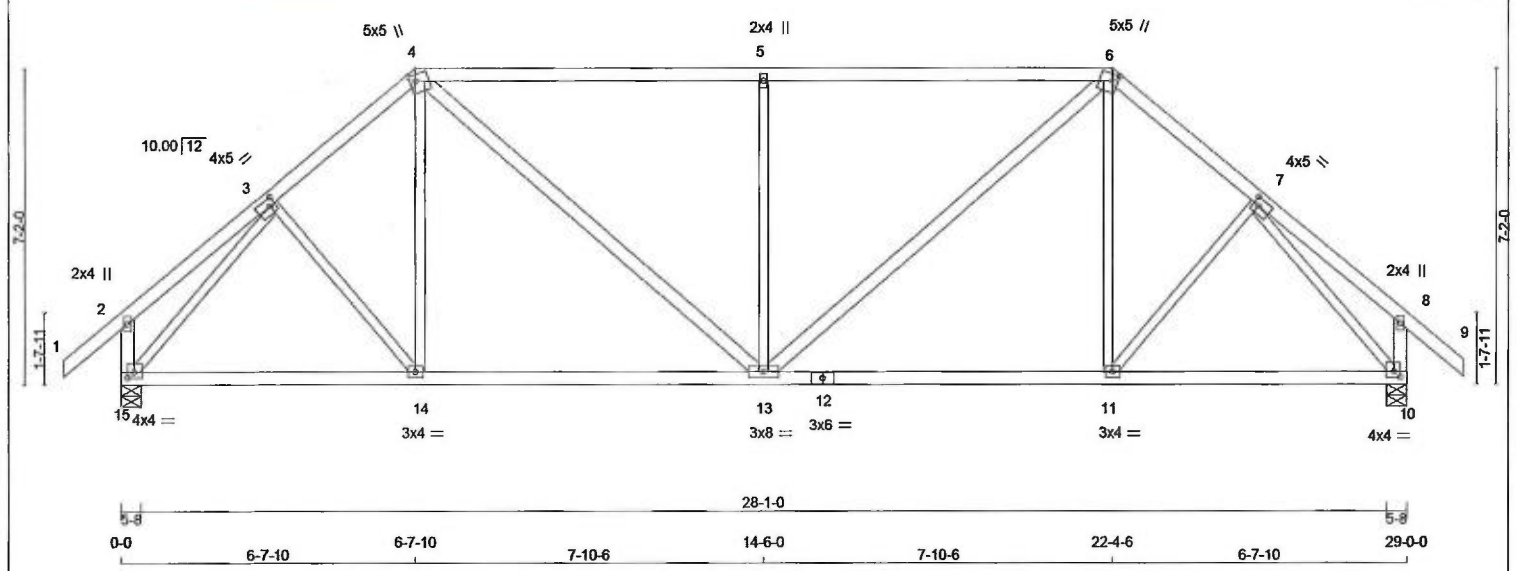

TOTAL WEIGHT = 133 lb [M]

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
1 - 4	2x4	DRY	No.2	SPF
4 - 6	2x4	DRY	2100F 1.8E	SPF
6 - 9	2x4	DRY	No.2	SPF
15 - 2	2x4	DRY	No.2	SPF
10 - 8	2x4	DRY	No.2	SPF
15 - 12	2x4	DRY	No.2	SPF
12 - 10	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
4 - 13	2x4	DRY	No.2	SPF
13 - 6	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
2	TMV+p	MT20	2.0	4.0	
3	TMWW-t	MT20	4.0	5.0	2.00 1.50
4	TTWW+m	MT20	5.0	5.0	1.75 1.50
5	TMW+w	MT20	2.0	4.0	
6	TTWW+m	MT20	5.0	5.0	1.75 1.50
7	TMWW-t	MT20	4.0	5.0	2.00 1.50
8	TMV+p	MT20	2.0	4.0	
10	BMVW1-t	MT20	4.0	4.0	1.50 1.75
11	BMVW1-t	MT20	3.0	4.0	
12	BS-t	MT20	3.0	6.0	
13	BMVW1-t	MT20	3.0	8.0	
14	BMVW1-t	MT20	3.0	4.0	
15	BMVW1-t	MT20	4.0	4.0	1.50 1.75

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG			
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
15	1483	0	1483	0	0	5-8	5-8
10	1483	0	1483	0	0	5-8	5-8

UNFACTORED REACTIONS							
JT	1ST LCASE COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
15	1038	740 / 0	0 / 0	0 / 0	0 / 0	298 / 0	0 / 0
10	1038	740 / 0	0 / 0	0 / 0	0 / 0	298 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 15, 10

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.38 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING							
TOTAL LOAD CASES: (4)							
CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	FACTORED MAX CSI (LC)
FR-TO		FROM TO		FR-TO			
1-2	0 / 34	-77.4	-77.4 0.11 (1)	10.00	3-14	0 / 61	0.02 (4)
2-3	0 / 17	-77.4	-77.4 0.12 (1)	10.00	14-4	0 / 114	0.04 (4)
3-4	-1374 / 0	-77.4	-77.4 0.15 (1)	5.39	4-13	0 / 672	0.11 (1)
4-5	-1547 / 0	-77.4	-77.4 0.62 (1)	5.38	13-5	-749 / 0	0.67 (1)
5-6	-1547 / 0	-77.4	-77.4 0.62 (1)	5.38	13-6	0 / 672	0.11 (1)
6-7	-1374 / 0	-77.4	-77.4 0.15 (1)	5.39	11-6	0 / 114	0.04 (4)
7-8	0 / 17	-77.4	-77.4 0.12 (1)	10.00	11-7	0 / 61	0.02 (4)
8-9	0 / 34	-77.4	-77.4 0.11 (1)	10.00	15-3	-1585 / 0	0.70 (1)
15-2	-207 / 0	0.0	0.0 0.02 (1)	7.81	7-10	-1585 / 0	0.70 (1)
10-8	-207 / 0	0.0	0.0 0.02 (1)	7.81			
15-14	0 / 1000	-17.5	-17.5 0.29 (4)	10.00			
14-13	0 / 1041	-17.5	-17.5 0.30 (4)	10.00			
13-12	0 / 1041	-17.5	-17.5 0.30 (4)	10.00			
12-11	0 / 1041	-17.5	-17.5 0.30 (4)	10.00			
11-10	0 / 1000	-17.5	-17.5 0.29 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.62/1.00 (4-5:1), BC=0.30/1.00 (11-13:4), WB=0.70/1.00 (7-10:1), SSI=0.30/1.00 (4-5:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (3) (INPUT = 0.90)
JSI METAL= 0.47 (7) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



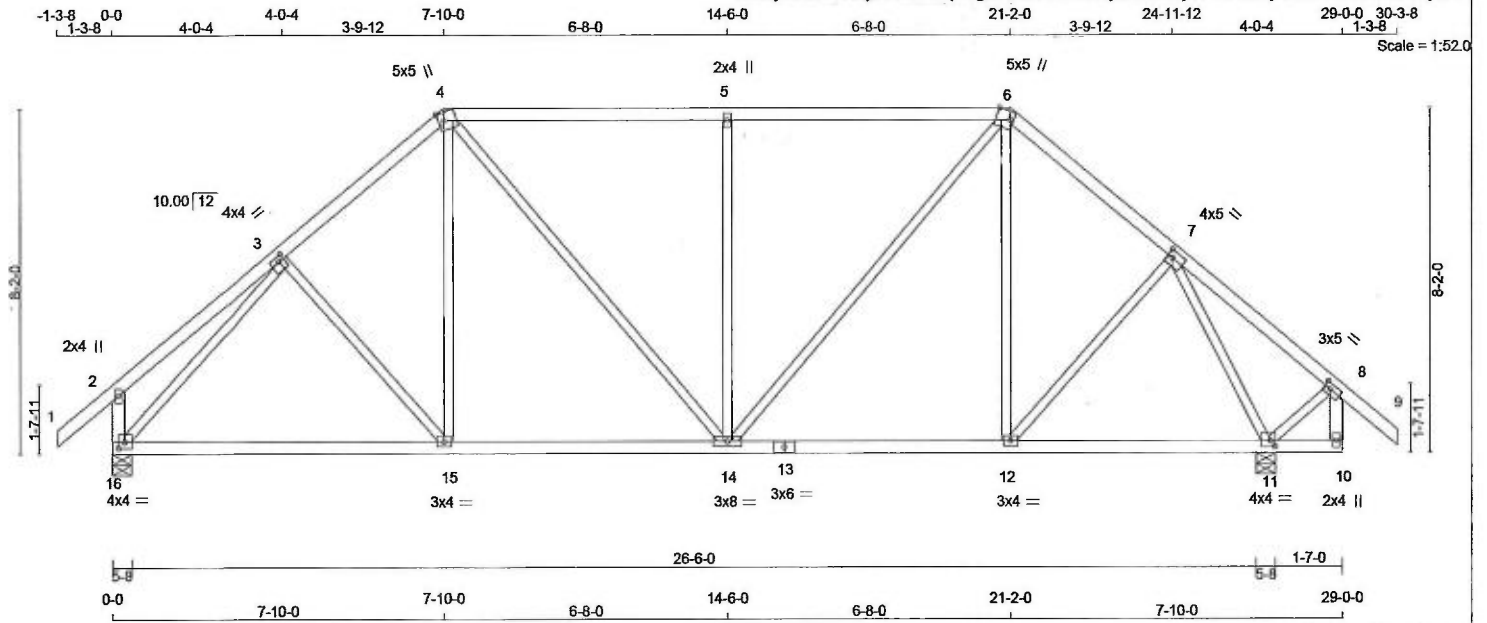

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
1 - 4	2x4	DRY	No.2	SPF
4 - 6	2x4	DRY	No.2	SPF
6 - 9	2x4	DRY	No.2	SPF
16 - 2	2x4	DRY	No.2	SPF
10 - 8	2x4	DRY	No.2	SPF
16 - 13	2x4	DRY	No.2	SPF
13 - 10	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMV+p	MT20	2.0	4.0		
3	TMWW-t	MT20	4.0	4.0	1.50	1.50
4	TTWW+m	MT20	5.0	5.0	2.25	1.50
5	TMW+w	MT20	2.0	4.0		
6	TTWW+m	MT20	5.0	5.0	Edge 4.00	
7	TMWW-t	MT20	4.0	5.0	2.00	1.50
8	TMWW-t	MT20	3.0	5.0	1.50	1.75
10	BMV+p	MT20	2.0	4.0		
11	BMWW-t	MT20	4.0	4.0	1.75	1.25
12	BMWW-t	MT20	3.0	4.0		
13	BS-t	MT20	3.0	6.0		
14	BMWW-t	MT20	3.0	8.0		
15	BMWW-t	MT20	3.0	4.0		
16	BMVW-t	MT20	4.0	4.0	1.75	1.75

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
11	1577	0		1577	0	0	5-8	5-8	
16	1388	0		1388	0	0	5-8	5-8	

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
11	1104	787 / 0	0 / 0	0 / 0	0 / 0	317 / 0	0 / 0	
16	972	693 / 0	0 / 0	0 / 0	0 / 0	279 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 11, 16

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.32 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 (LC)	
FR-TO		FROM	TO	FR-TO			
1-2	0 / 34	-77.4	-77.4 0.11 (1)	10.00	3-15	-45 / 36	0.03 (1)
2-3	0 / 22	-77.4	-77.4 0.18 (1)	10.00	15-4	0 / 181	0.05 (4)
3-4	-1221 / 0	-77.4	-77.4 0.16 (1)	5.64	4-14	0 / 356	0.08 (1)
4-5	-1151 / 0	-77.4	-77.4 0.47 (1)	5.32	14-5	-634 / 0	0.82 (1)
5-6	-1151 / 0	-77.4	-77.4 0.47 (1)	5.32	14-6	0 / 612	0.14 (1)
6-7	-1013 / 0	-77.4	-77.4 0.17 (1)	6.04	12-6	-140 / 39	0.18 (1)
7-8	0 / 193	-77.4	-77.4 0.23 (1)	10.00	12-7	0 / 331	0.07 (1)
8-9	0 / 34	-77.4	-77.4 0.11 (1)	10.00	7-11	-1531 / 0	0.69 (1)
16-2	-223 / 0	0.0	0.0 0.02 (1)	7.81	16-3	-1459 / 0	0.88 (1)
10-8	-20 / 0	0.0	0.0 0.00 (1)	7.81	11-8	-163 / 0	0.03 (1)
16-15	0 / 948	-17.5	-17.5 0.31 (4)	10.00			
15-14	0 / 921	-17.5	-17.5 0.32 (4)	10.00			
14-13	0 / 755	-17.5	-17.5 0.21 (4)	10.00			
13-12	0 / 755	-17.5	-17.5 0.21 (4)	10.00			
12-11	0 / 544	-17.5	-17.5 0.19 (4)	10.00			
11-10	0 / 0	-17.5	-17.5 0.11 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	33.3	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.91")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL)= L/360 (0.91")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CANTILEVER DEFLECTION:
ALLOWABLE DEFL.(LL)= L/120 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/120 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.47/1.00 (4-5:1), BC=0.32/1.00 (14-15:4),
WB=0.88/1.00 (3-16:1), SSI=0.25/1.00 (4-5:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
NE0818-069	T04	1	1	GREENPARK - MINNISALE HOMES MILLWOOD 3 ELE 1	PAGE 28 OF 40
TRUSS DESC.					

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Aug 14 13:24:43 2018 Page 2
ID:luy2SMGWusjlvMKN0gKdgz4O6R-FHIV3rhjhmo0Lmjl7PQ7M02jAXOuCx7X01u8OTynx6Y

JSI GRIP= 0.69 (6) (INPUT = 0.90)
JSI METAL= 0.54 (3) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



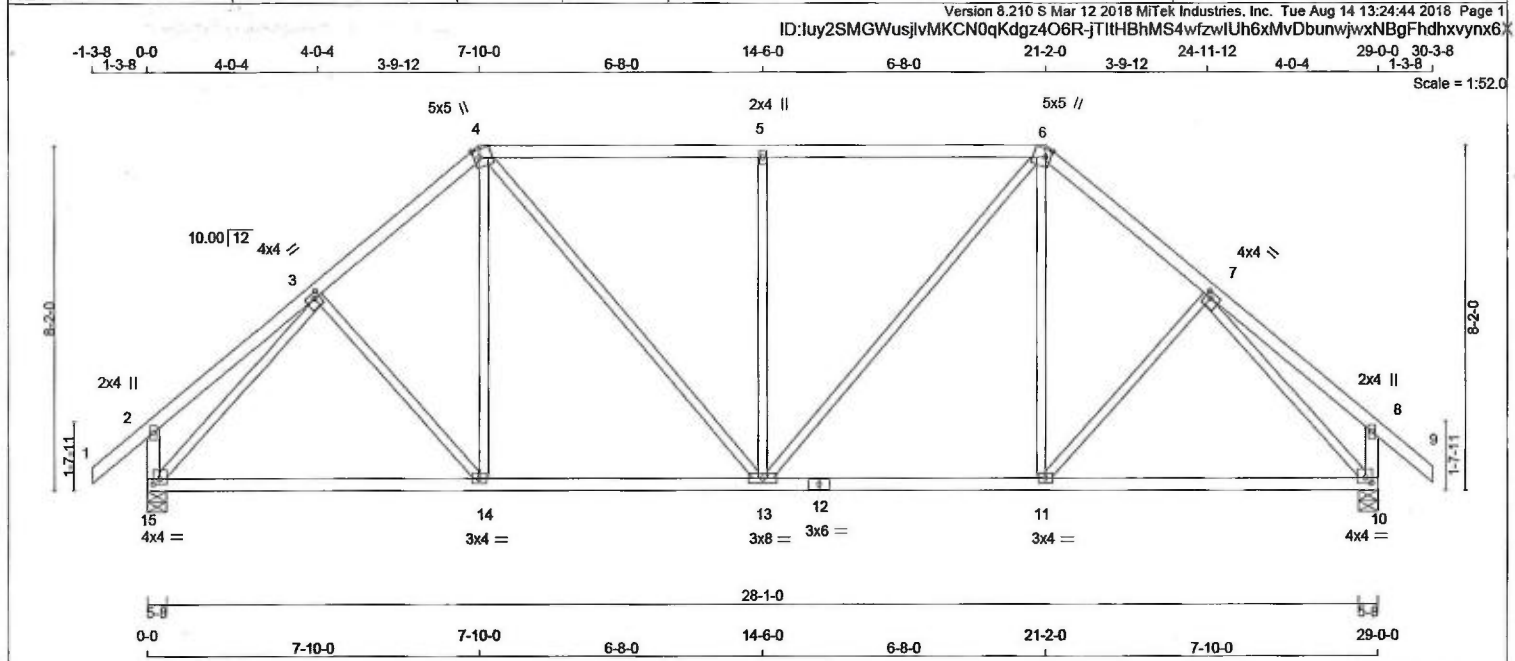

TOTAL WEIGHT = 132 lb [MJF]

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
1 - 4	2x4	DRY	No.2	SPF
4 - 6	2x4	DRY	No.2	SPF
6 - 9	2x4	DRY	No.2	SPF
15 - 2	2x4	DRY	No.2	SPF
10 - 8	2x4	DRY	No.2	SPF
15 - 12	2x4	DRY	No.2	SPF
12 - 10	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
2 TMV+p	MT20	2.0	4.0				
3 TMWW-t	MT20	4.0	4.0	1.50	1.50		
4 TTWW+m	MT20	5.0	5.0	2.25	1.50		
5 TMW+w	MT20	2.0	4.0				
6 TTWW+m	MT20	5.0	5.0	2.25	1.50		
7 TMWW-t	MT20	4.0	4.0	1.50	1.50		
8 TMV+p	MT20	2.0	4.0				
10 BMVW1-t	MT20	4.0	4.0	1.50	1.75		
11 BMWW-t	MT20	3.0	4.0				
12 BS-t	MT20	3.0	6.0				
13 BMWWW-t	MT20	3.0	8.0				
14 BMWW-t	MT20	3.0	4.0				
15 BMVW1-t	MT20	4.0	4.0	1.50	1.75		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	IN-SX
15	1483	0	1483	0	0	5-8	5-8	5-8	5-8
10	1483	0	1483	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN	COMPONENT REACTIONS	WIND	DEAD	SOIL
15	1038	740 / 0	0 / 0	0 / 0	298 / 0	0 / 0
10	1038	740 / 0	0 / 0	0 / 0	298 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 15, 10

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.03 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MEMB.		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (CSI (LC))	MAX. UNBRAC	MEMB.	FORCE (LBS)	MAX. FACTORED (CSI (LC))
FR-TO		FROM	TO	LENGTH	FR-TO		
1-2	0 / 34	-77.4	-77.4 0.11 (1)	10.00	3-14	-24 / 42	0.02 (1)
2-3	0 / 22	-77.4	-77.4 0.18 (1)	10.00	14-4	0 / 168	0.05 (4)
3-4	-1344 / 0	-77.4	-77.4 0.16 (1)	5.44	4-13	0 / 476	0.11 (1)
4-5	-1324 / 0	-77.4	-77.4 0.47 (1)	5.03	13-5	-633 / 0	0.82 (1)
5-6	-1324 / 0	-77.4	-77.4 0.47 (1)	5.03	13-6	0 / 476	0.11 (1)
6-7	-1344 / 0	-77.4	-77.4 0.16 (1)	5.44	11-6	0 / 168	0.05 (4)
7-8	0 / 22	-77.4	-77.4 0.18 (1)	10.00	11-7	-24 / 42	0.02 (1)
8-9	0 / 34	-77.4	-77.4 0.11 (1)	10.00	15-3	-1583 / 0	0.96 (1)
15-2	-224 / 0	0.0	0.0 0.02 (1)	7.81	7-10	-1583 / 0	0.96 (1)
10-8	-224 / 0	0.0	0.0 0.02 (1)	7.81			
15-14	0 / 1029	-17.5	-17.5 0.32 (4)	10.00			
14-13	0 / 1016	-17.5	-17.5 0.33 (4)	10.00			
13-12	0 / 1016	-17.5	-17.5 0.33 (4)	10.00			
12-11	0 / 1016	-17.5	-17.5 0.33 (4)	10.00			
11-10	0 / 1029	-17.5	-17.5 0.32 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 23.3 PSF

DL = 3.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.0 PSF

TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, CBC 2012, ABC 2014

- CSA 086-09

- TPIC 2011

(55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")

CALCULATED VERT. DEFL.(LL)= L/999 (0.05")

ALLOWABLE DEFL.(TL)= L/360 (0.97")

CALCULATED VERT. DEFL.(TL)= L/999 (0.13")

CSI: TC=0.47/1.00 (4-5:1), BC=0.33/1.00 (11-13:4)

, WB=0.96/1.00 (7-10:1), SSI=0.25/1.00 (4-5:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.90 (3) (INPUT = 0.90)

JSI METAL= 0.58 (3) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



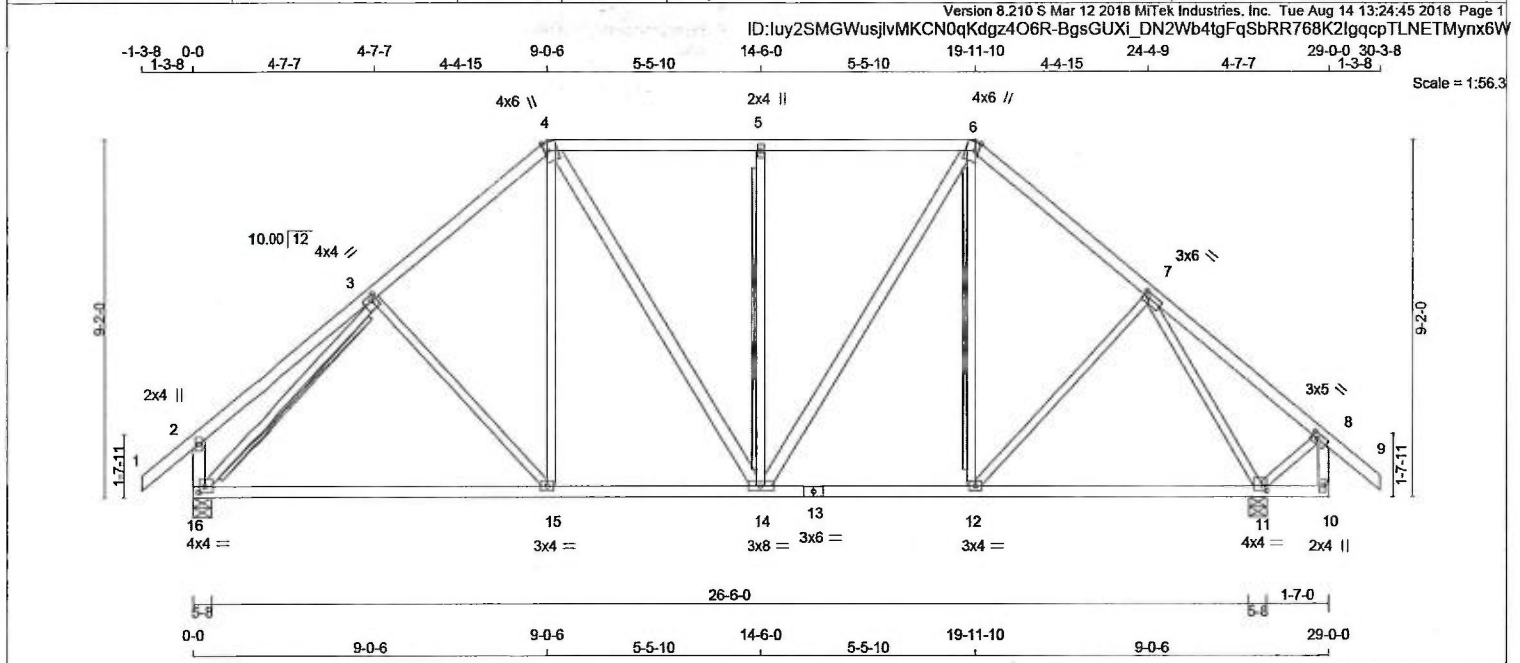

TOTAL WEIGHT = 145 lb [MJF]

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
1 - 4	2x4	DRY	No.2	SPF	
4 - 6	2x4	DRY	No.2	SPF	
6 - 9	2x4	DRY	No.2	SPF	
16 - 2	2x4	DRY	No.2	SPF	
10 - 8	2x4	DRY	No.2	SPF	
16 - 13	2x4	DRY	No.2	SPF	
13 - 10	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	
4 - 14	2x4	DRY	No.2	SPF	
14 - 6	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
1	TMV+p	MT20	2.0	4.0		
3	TMWW-t	MT20	4.0	4.0	1.50	1.50
4	TTWW+m	MT20	4.0	6.0	Edge	1.00
5	TMW+w	MT20	2.0	4.0		
6	TTWW+m	MT20	4.0	6.0	Edge	1.00
7	TMWW-t	MT20	3.0	6.0	1.50	1.50
8	TMVW-t	MT20	3.0	5.0	1.50	1.75
10	BMV+p	MT20	2.0	4.0		
11	BMWW1-t	MT20	4.0	4.0	1.50	1.25
12	BMWW-t	MT20	3.0	4.0		
13	BS-t	MT20	3.0	6.0		
14	BMWWW-t	MT20	3.0	8.0		
15	BMWW-t	MT20	3.0	4.0		
16	BMVW1-t	MT20	4.0	4.0	1.75	1.75

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG	BRG
11	1577	0	1577	0	0	5-8	5-8	5-8	5-8
16	1389	0	1389	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS							
1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
11	1104	787 / 0	0 / 0	0 / 0	0 / 0	317 / 0	0 / 0
16	972	693 / 0	0 / 0	0 / 0	0 / 0	279 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 11, 16

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.65 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT 5-14, 6-12, 3-16

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD LC1 (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
1-2	0 / 34	-77.4	-77.4 0.11 (1)	10.00	3-15	-119 / 22	0.10 (1)
2-3	0 / 26	-77.4	-77.4 0.25 (1)	10.00	15-4	0 / 251	0.06 (4)
3-4	-1178 / 0	-77.4	-77.4 0.22 (1)	5.65	4-14	0 / 222	0.04 (1)
4-5	-1003 / 0	-77.4	-77.4 0.31 (1)	5.86	14-5	-517 / 0	0.32 (1)
5-6	-1003 / 0	-77.4	-77.4 0.31 (1)	5.86	14-6	0 / 458	0.07 (1)
6-7	-1024 / 0	-77.4	-77.4 0.22 (1)	5.94	12-6	-41 / 70	0.03 (1)
7-8	0 / 197	-77.4	-77.4 0.29 (1)	10.00	12-7	0 / 212	0.05 (1)
8-9	0 / 34	-77.4	-77.4 0.11 (1)	10.00	7-11	-1540 / 0	0.95 (1)
16-2	-240 / 0	0.0	0.0 0.03 (1)	7.81	16-3	-1450 / 0	0.49 (1)
10-8	-36 / 0	0.0	0.0 0.00 (4)	7.81	11-8	-164 / 3	0.03 (1)
16-15	0 / 964	-17.5	-17.5 0.38 (4)	10.00			
15-14	0 / 886	-17.5	-17.5 0.38 (4)	10.00			
14-13	0 / 762	-17.5	-17.5 0.22 (4)	10.00			
13-12	0 / 762	-17.5	-17.5 0.22 (4)	10.00			
12-11	0 / 623	-17.5	-17.5 0.22 (1)	10.00			
11-10	0 / 0	-17.5	-17.5 0.17 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.91")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL)= L/360 (0.91")
CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CANTILEVER DEFLECTION:
ALLOWABLE DEFL.(LL)= L/120 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/120 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.31/1.00 (4-5:1), BC=0.38/1.00 (14-15:4), WB=0.95/1.00 (7-11:1), SSI=0.20/1.00 (4-5:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
NE0818-069	T05	1	1	GREENPARK - MINNISALE HOMES MILLWOOD 3 ELE 1	PAGE 31 OF 40
TRUSS DESC.					

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Aug 14 13:24:45 2018 Page 2
ID:luy2SMGWusjivMKCN0qKdgz4O6R-BgsGUXi DN2Wb4tgFqSbRR768K2lgqcpTLNETMynx6W

JSI GRIP= 0.90 (7) (INPUT = 0.90)
JSI METAL= 0.54 (3) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



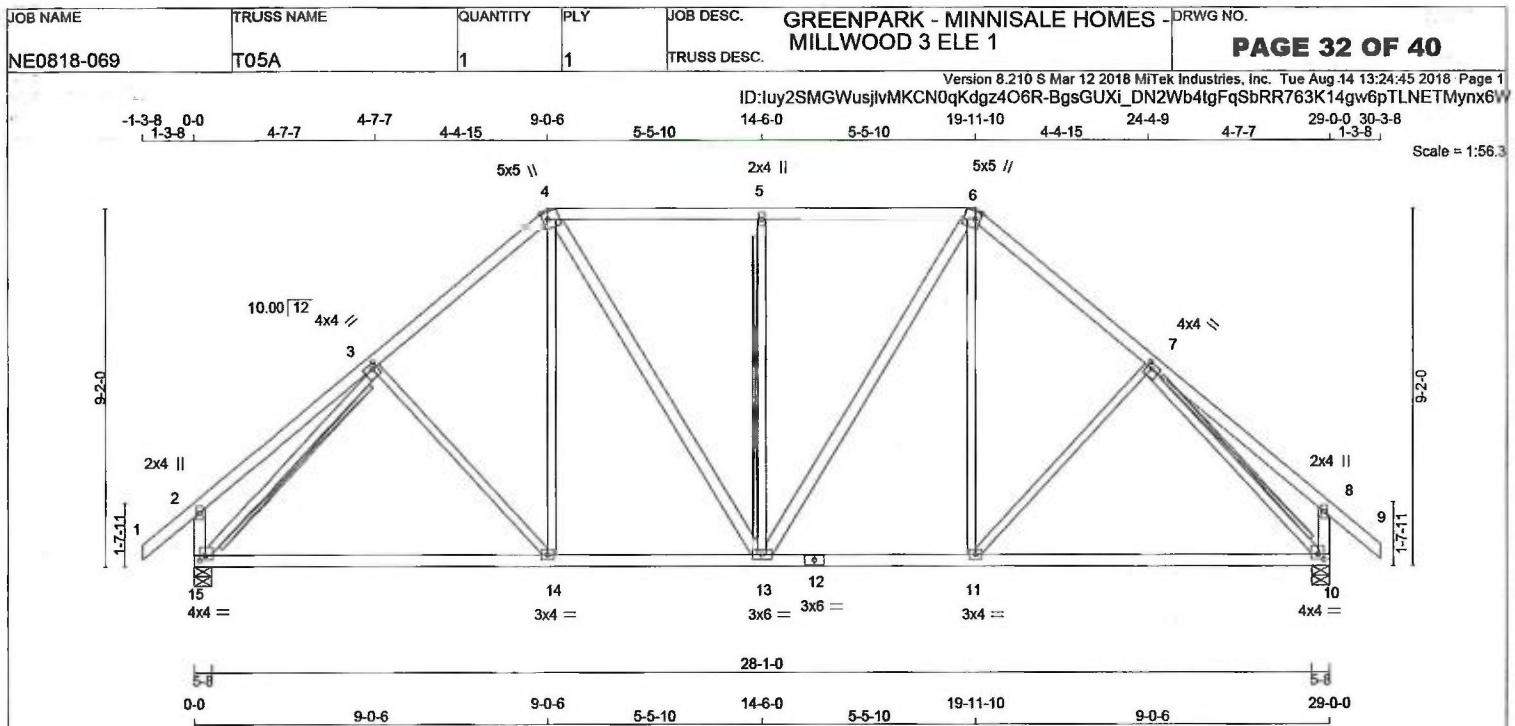

TOTAL WEIGHT = 144 lb

[M]F

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
1 - 4	2x4	DRY	No.2 SPF
4 - 6	2x4	DRY	No.2 SPF
6 - 9	2x4	DRY	No.2 SPF
15 - 2	2x4	DRY	No.2 SPF
10 - 8	2x4	DRY	No.2 SPF
15 - 12	2x4	DRY	No.2 SPF
12 - 10	2x4	DRY	No.2 SPF
ALL WEBS	2x3	DRY	No.2 SPF
EXCEPT			
4 - 13	2x4	DRY	No.2 SPF
13 - 6	2x4	DRY	No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMV+p	MT20	2.0	4.0		
3	TMWV-l	MT20	4.0	4.0	1.50	1.50
4	TTWW+m	MT20	5.0	5.0	2.25	1.50
5	TMW+v	MT20	2.0	4.0		
6	TTWW+m	MT20	5.0	5.0	2.25	1.50
7	TMWV-l	MT20	4.0	4.0	1.50	1.50
8	TMV+p	MT20	2.0	4.0		
10	BMVWV-l	MT20	4.0	4.0	1.50	1.75
11	BMWV-l	MT20	3.0	4.0		
12	BS-l	MT20	3.0	6.0		
13	BMWVW-l	MT20	3.0	6.0		
14	BMWV-l	MT20	3.0	4.0		
15	BMVWV-l	MT20	4.0	4.0	1.50	1.75

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT DOWN	REQD BRG IN-SX
JT	VERT	HORZ	HORZ	UPLIFT
15	1483	0	1483	0
10	1483	0	1483	0

UNFACTORED REACTIONS

	1ST LCASE COMBINED	MAX/MIN. SNOW	MAX/MIN. LIVE	MAX/MIN. PERM. LIVE	MAX/MIN. WIND	MAX/MIN. DEAD	MAX/MIN. SOIL
JT							
15	1038	740 / 0	0 / 0	0 / 0	0 / 0	298 / 0	0 / 0
10	1038	740 / 0	0 / 0	0 / 0	0 / 0	298 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 15, 10

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.43 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT 5-13, 3-15, 7-10

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3"
 COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN
 THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRAC LENGTH	FR-TO	FROM	TO	CS (LC)	MAX. UNBRAC LENGTH	FR-TO	FROM	TO	CS (LC)	MAX. UNBRAC LENGTH
1-2	0 / 34	-77.4	-77.4	0.11 (1)	10.00	3-14	-101 / 27	0.09 (1)						
2-3	0 / 26	-77.4	-77.4	0.25 (1)	10.00	14-4	0 / 241	0.06 (4)						
3-4	-1304 / 0	-77.4	-77.4	0.22 (1)	5.43	4-13	0 / 328	0.05 (1)						
4-5	-1154 / 0	-77.4	-77.4	0.31 (1)	5.55	13-5	-516 / 0	0.32 (1)						
5-6	-1154 / 0	-77.4	-77.4	0.31 (1)	5.55	13-6	0 / 328	0.05 (1)						
6-7	-1304 / 0	-77.4	-77.4	0.22 (1)	5.43	11-6	0 / 241	0.06 (4)						
7-8	0 / 26	-77.4	-77.4	0.25 (1)	10.00	11-7	-101 / 27	0.09 (1)						
8-9	0 / 34	-77.4	-77.4	0.11 (1)	10.00	15-3	-1576 / 0	0.53 (1)						
15-2	-240 / 0	0.0	0.0	0.03 (1)	7.81	7-10	-1576 / 0	0.53 (1)						
10-8	-240 / 0	0.0	0.0	0.03 (1)	7.81									
15-14	0 / 1047	-17.5	-17.5	0.39 (4)	10.00									
14-13	0 / 982	-17.5	-17.5	0.40 (4)	10.00									
13-12	0 / 982	-17.5	-17.5	0.40 (4)	10.00									
12-11	0 / 982	-17.5	-17.5	0.40 (4)	10.00									
11-10	0 / 1047	-17.5	-17.5	0.39 (4)	10.00									

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3 PSF
	DL = 3.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.0 PSF
TOTAL LOAD	= 33.3 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
 ALLOWABLE DEFL.(TL)= L/360 (0.97")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.21")

CSI: TC=0.31/1.00 (4-5:1), BC=0.40/1.00 (11-13:4)
 WB=0.53/1.00 (7-10:1), SSI=0.20/1.00 (4-5:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667
	822	2284	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (3) (INPUT = 0.90)

JSI METAL= 0.58 (3) (INPUT = 1.00)

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Aug 14 13:24:46 2018 Page 1
ID: iuy2SMGWusjlvMKCN0qKdgz4O6R-gsQehljc_hANCESSpXzq_egGikPIPNYzi76o?oynx6V

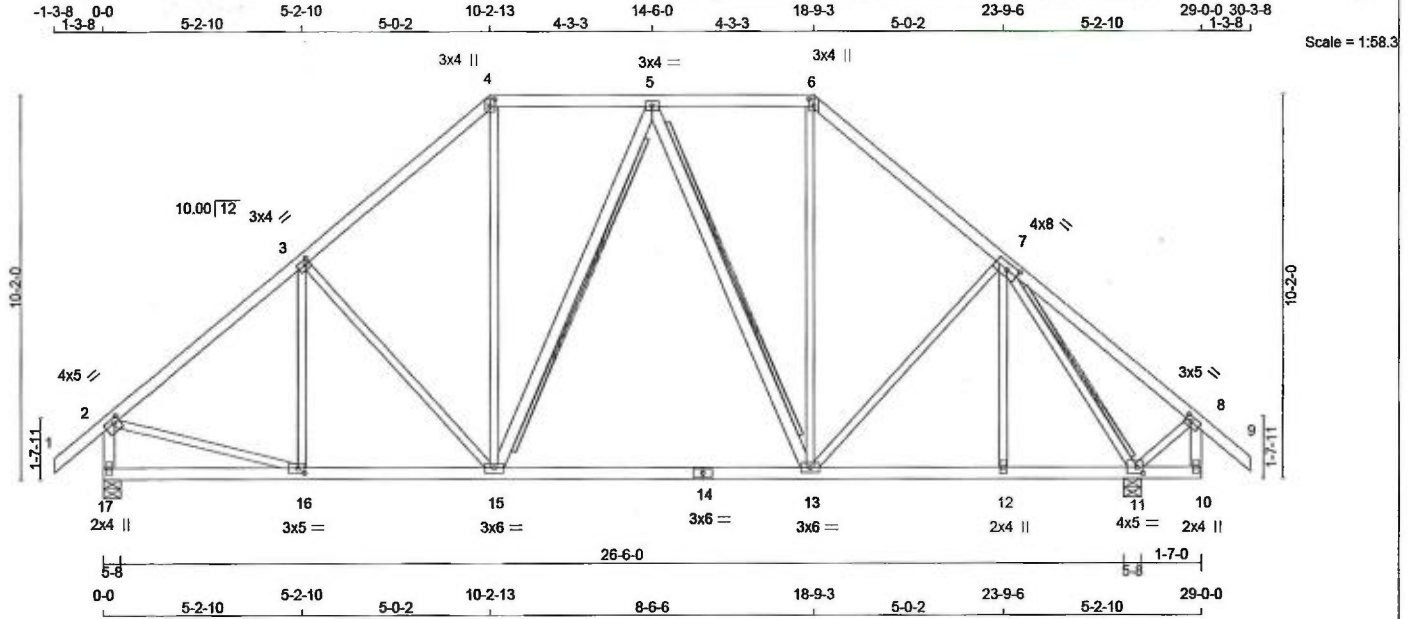

TOTAL WEIGHT = 2 X 151 = 302 lb [M/F]

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
1 - 4	2x4	DRY	No.2	SPF	
4 - 6	2x4	DRY	No.2	SPF	
6 - 9	2x4	DRY	No.2	SPF	
17 - 2	2x4	DRY	No.2	SPF	
10 - 8	2x4	DRY	No.2	SPF	
17 - 14	2x4	DRY	No.2	SPF	
14 - 10	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
15 - 5	2x4	DRY	No.2	SPF	
5 - 13	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMVW-t	MT20	4.0	5.0	1.50	1.75
3	TMWW-t	MT20	3.0	4.0	1.50	1.25
4	TTW+p	MT20	3.0	4.0	2.25	1.50
5	TMWW-t	MT20	3.0	4.0		
6	TTW+p	MT20	3.0	4.0	2.25	1.50
7	TMWWW-t	MT20	4.0	8.0	2.00	3.50
8	TMVW-t	MT20	3.0	5.0	1.50	1.75
10	BMV+p	MT20	2.0	4.0		
11	BMWW-t	MT20	4.0	5.0	2.00	1.75
12	BMW+w	MT20	2.0	4.0		
13	BMWWW-t	MT20	3.0	6.0		
14	BS-t	MT20	3.0	6.0		
15	BMWWW-t	MT20	3.0	6.0		
16	BMWW-t	MT20	3.0	5.0	1.50	2.00
17	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS								
	FACTORED		MAXIMUM FACTORED			INPUT	REQ'D	
	GROSS REACTION		GROSS REACTION			BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
17	1389	0	1389	0	0	5-8	5-8	
11	1576	0	1576	0	0	5-8	5-8	

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN	COMPONENT REACTIONS	PERM.LIVE	WIND	DEAD	SOIL
17	973	693 / 0	0 / 0	0 / 0	0 / 0	279 / 0	0 / 0
11	1104	786 / 0	0 / 0	0 / 0	0 / 0	317 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 17, 11

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.39 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT 5-15, 5-13, 7-11

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
1-2	0 / 34	-77.4 -77.4 0.11 (1)	10.00	16-3	-164 / 26	0.09 (1)	
2-3	-1276 / 0	-77.4 -77.4 0.29 (1)	5.39	3-15	-254 / 0	0.30 (1)	
3-4	-1118 / 0	-77.4 -77.4 0.28 (1)	5.88	15-4	0 / 422	0.09 (1)	
4-5	-837 / 0	-77.4 -77.4 0.18 (1)	6.25	15-5	-116 / 6	0.10 (1)	
5-6	-759 / 0	-77.4 -77.4 0.18 (1)	6.25	5-13	-317 / 0	0.26 (1)	
6-7	-1017 / 0	-77.4 -77.4 0.28 (1)	5.88	13-6	0 / 358	0.08 (1)	
7-8	0 / 224	-77.4 -77.4 0.37 (1)	10.00	13-7	0 / 98	0.02 (1)	
8-9	0 / 34	-77.4 -77.4 0.11 (1)	10.00	12-7	0 / 61	0.02 (4)	
17-2	-1349 / 0	0.0 0.0 0.14 (1)	6.98	7-11	-1593 / 0	0.52 (1)	
10-8	-26 / 0	0.0 0.0 0.00 (1)	7.81	2-16	0 / 1034	0.23 (1)	
				11-8	-186 / 0	0.03 (1)	
17-16	0 / 0	-17.5 -17.5 0.10 (4)	10.00				
16-15	0 / 1003	-17.5 -17.5 0.27 (1)	10.00				
15-14	0 / 882	-17.5 -17.5 0.27 (4)	10.00				
14-13	0 / 882	-17.5 -17.5 0.27 (4)	10.00				
13-12	0 / 690	-17.5 -17.5 0.26 (4)	10.00				
12-11	0 / 690	-17.5 -17.5 0.21 (1)	10.00				
11-10	0 / 0	-17.5 -17.5 0.10 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
DL = 3.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.0	PSF	
TOTAL LOAD =	33.3	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.91")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL)= L/360 (0.91")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CANTILEVER DEFLECTION:
ALLOWABLE DEFL.(LL)= L/120 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/120 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.37/1.00 (7-8:1), BC=0.27/1.00 (13-15:4), WB=0.52/1.00 (7-11:1), SSI=0.16/1.00 (4-5:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
NE0818-069	T06	2	1	GREENPARK - MINNISALE HOMES MILLWOOD 3 ELE 1	PAGE 34 OF 40

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Aug 14 13:24:46 2018 Page 2
ID:1uy2SMGWusjlvMKCN0qKdgz4O6R-gsQehtjc_hANCESspXzq_egGtlkPIPNYzi?6o?oynx6V

JSI GRIP= 0.90 (4) (INPUT = 0.90)
JSI METAL= 0.44 (2) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



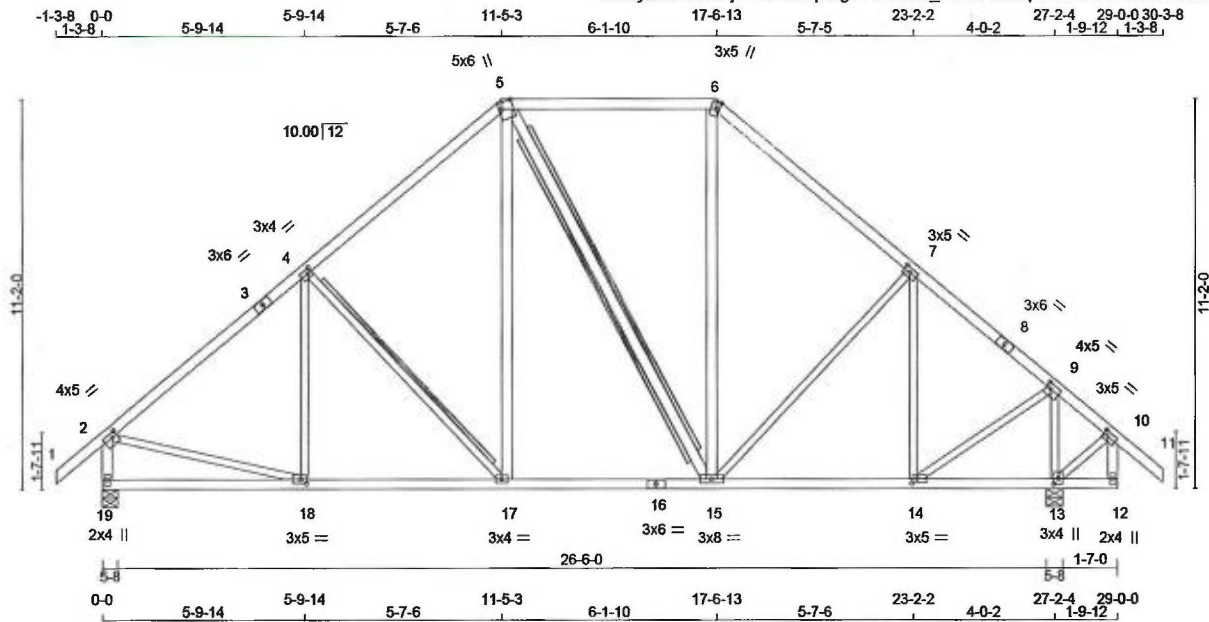

Scale = 1:62.9


TOTAL WEIGHT = 2 X 154 = 307 lb

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER	DESCR	
1 - 3	2x4	DRY	No.2	SPF	
3 - 5	2x4	DRY	No.2	SPF	
5 - 6	2x4	DRY	No.2	SPF	
6 - 8	2x4	DRY	No.2	SPF	
8 - 11	2x4	DRY	No.2	SPF	
19- 2	2x4	DRY	No.2	SPF	
12- 10	2x4	DRY	No.2	SPF	
19- 16	2x4	DRY	No.2	SPF	
16- 12	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT		2x3	DRY	No.2	SPF
17- 5	2x4	DRY	No.2	SPF	
5 - 15	2x4	DRY	No.2	SPF	
15- 6	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER

PLATES (table is in Inches)						
JT	TYPE	PLATES	W	LEN	Y	X
3	TMVW-I	MT20	4.0	5.0	1.50	1.75
4	TS-I	MT20	3.0	6.0		
4	TMWW-I	MT20	3.0	4.0	1.50	1.25
6	TTWW+m	MT20	5.0	6.0	Edge	4.00
6	TTW+m	MT20	3.0	5.0	Edge	1.00
7	TMWW-I	MT20	3.0	5.0	1.50	2.25
8	TS-I	MT20	3.0	6.0		
9	TMWW-I	MT20	4.0	5.0	1.75	1.75
10	TMVW-I	MT20	3.0	5.0	1.50	1.75
12	BMV+p	MT20	2.0	4.0		
13	BMWW1+I	MT20	3.0	4.0	1.75	1.50
14	BMWW-I	MT20	3.0	5.0	1.50	1.75
15	BMWWW-I	MT20	3.0	8.0		
16	BS-I	MT20	3.0	6.0		
17	BMWW-I	MT20	3.0	4.0		
18	BMWW-I	MT20	3.0	5.0	1.50	2.00
19	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED		MAXIMUM FACTORED			INPUT	REQRD
	GROSS REACTION		GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
19	1381	0	1381	0	0	5-8	5-8
13	1584	0	1584	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
19	967	689 / 0	0 / 0	0 / 0	0 / 0	278 / 0	0 / 0
13	1109	791 / 0	0 / 0	0 / 0	0 / 0	318 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 19, 13

BRACING

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.29 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT 4-17
2x4 DRY SPF No.2 I-BRACE AT 5-15

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
1-2	0 / 34	-77.4	-77.4 0.11 (1)	10.00	18-4	-112 / 61	0.08 (1)
2-3	-1271 / 0	-77.4	-77.4 0.37 (1)	5.29	4-7	-339 / 0	0.18 (1)
3-4	-1271 / 0	-77.4	-77.4 0.37 (1)	5.29	7-5	0 / 346	0.06 (1)
4-5	-1040 / 0	-77.4	-77.4 0.35 (1)	5.73	5-15	-114 / 0	0.10 (1)
5-6	-720 / 0	-77.4	-77.4 0.36 (1)	6.25	15-6	0 / 188	0.03 (4)
6-7	-862 / 0	-77.4	-77.4 0.30 (1)	5.97	15-7	0 / 28	0.01 (1)
7-8	-879 / 0	-77.4	-77.4 0.25 (1)	6.24	14-7	-501 / 0	0.34 (1)
8-9	-879 / 0	-77.4	-77.4 0.25 (1)	6.24	14-9	0 / 1006	0.23 (1)
9-10	0 / 147	-77.4	-77.4 0.12 (1)	10.00	13-9	-1417 / 0	0.26 (1)
10-11	0 / 34	-77.4	-77.4 0.11 (1)	10.00	2-18	0 / 1027	0.23 (1)
19-2	-1339 / 0	0.0	0.0 0.14 (1)	7.00	13-10	-153 / 0	0.02 (1)
12-10	-7 / 5	0.0	0.0 0.00 (4)	7.61			
19-18	0 / 0	-17.5	-17.5 0.14 (4)	10.00			
18-17	0 / 1002	-17.5	-17.5 0.23 (1)	10.00			
17-16	0 / 775	-17.5	-17.5 0.20 (1)	10.00			
16-15	0 / 775	-17.5	-17.5 0.20 (1)	10.00			
15-14	0 / 699	-17.5	-17.5 0.19 (1)	10.00			
14-13	-124 / 0	-17.5	-17.5 0.06 (4)	6.25			
13-12	0 / 0	-17.5	-17.5 0.06 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

SPECIFIED LOADS.			
TOP	CH.	LL =	23.3 PSF
		DL =	3.0 PSF
BOT	CH.	LL =	0.0 PSF
		DL =	7.0 PSF
TOTAL LOAD		=	33.3 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 2.00/12 MINIMUM

**THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010**

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.91")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL)= L/360 (0.91")
CALCULATED VERT. DEFL.(TL) = L/999 (0.07")

CANTILEVER DEFLECTION:
ALLOWABLE DEFL.(LL)= $L/120$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL)= $L/120$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.38/1.00 (5-6:1), BC=0.23/1.00 (17-18:1)
WB=0.34/1.00 (7-14:1), SSI=0.19/1.00 (5-6:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**

CONTINUED ON PAGE 2




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
NE0818-069	T07	2	1	GREENPARK - MINNISALE HOMES MILLWOOD 3 ELE 1	PAGE 36 OF 40
TRUSS DESC.					

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Tue Aug 14 13:24:47 2018 Page 2
ID:luy2SMGWusjlvmKCN0qKdgz4O6R-82_0vDkEI?IEqO13MFU3WsDRV8m68iX6xfsLXEynx6U

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.90 (7) (INPUT = 0.90)
JSI METAL= 0.44 (2) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



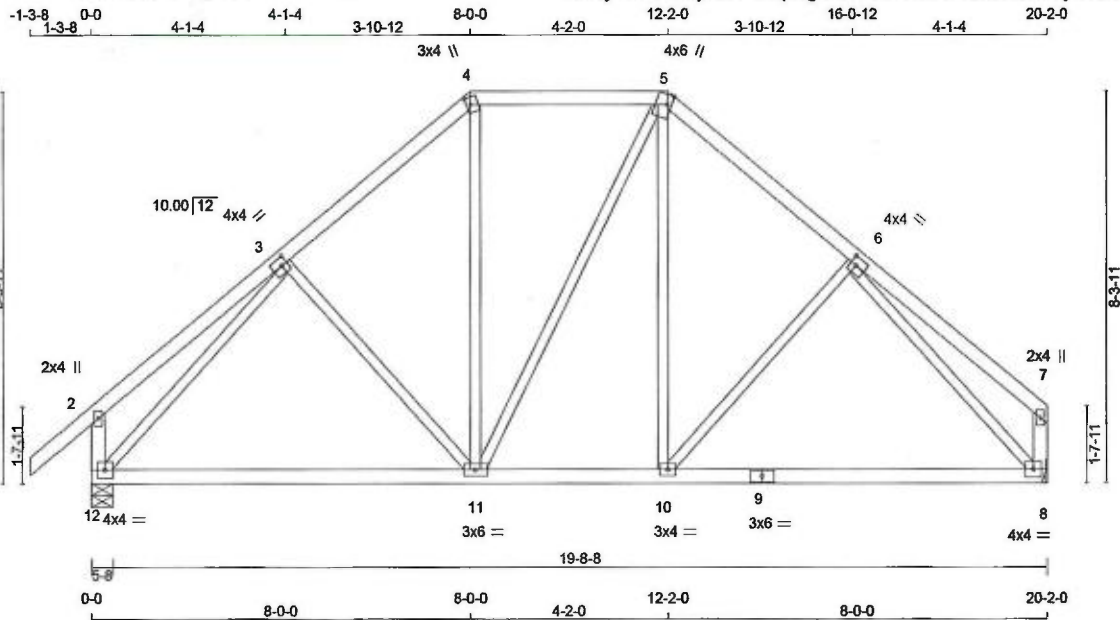

TOTAL WEIGHT = 95 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
1 - 4	2x4	DRY	No.2	SPF	
4 - 5	2x4	DRY	No.2	SPF	
5 - 7	2x4	DRY	No.2	SPF	
12 - 2	2x4	DRY	No.2	SPF	
8 - 7	2x4	DRY	No.2	SPF	
12 - 9	2x4	DRY	No.2	SPF	
9 - 8	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF
 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMV+p	MT20	2.0	4.0		
3	TMWW-t	MT20	4.0	4.0	2.00	1.50
4	TTW+m	MT20	3.0	4.0	2.00	1.00
5	TTWW+m	MT20	4.0	6.0	Edge	1.00
6	TMWW-t	MT20	4.0	4.0	2.00	1.50
7	TMV+p	MT20	2.0	4.0		
8	BMVW1-t	MT20	4.0	4.0		
9	BS-t	MT20	3.0	6.0		
10	BMWW-t	MT20	3.0	4.0		
11	BMWWW-t	MT20	3.0	6.0		
12	BMVW1-t	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
12	1064	0	0	5-8
8	957	0	0	MECHANICAL

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT 8 TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
12	744	534 / 0	0 / 0	0 / 0	210 / 0	0 / 0
8	671	470 / 0	0 / 0	0 / 0	202 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 12

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
1-2	0 / 34	-77.4 -77.4	0.11 (1)	10.00	3-11	-126 / 12	0.09 (1)
2-3	0 / 23	-77.4 -77.4	0.20 (1)	10.00	11-4	0 / 211	0.05 (1)
3-4	-788 / 0	-77.4 -77.4	0.16 (1)	6.25	11-5	0 / 0	0.00 (1)
4-5	-589 / 0	-77.4 -77.4	0.18 (1)	6.25	10-5	0 / 210	0.05 (1)
5-6	-788 / 0	-77.4 -77.4	0.16 (1)	6.25	10-6	-126 / 12	0.09 (1)
6-7	0 / 23	-77.4 -77.4	0.20 (1)	10.00	12-3	-1028 / 0	0.65 (1)
12-2	-225 / 0	0.0 0.0	0.02 (1)	7.81	6-8	-1028 / 0	0.65 (1)
8-7	-118 / 0	0.0 0.0	0.01 (1)	7.81			
12-11	0 / 671	-17.5 -17.5	0.28 (4)	10.00			
11-10	0 / 589	-17.5 -17.5	0.26 (4)	10.00			
10-9	0 / 670	-17.5 -17.5	0.28 (4)	10.00			
9-8	0 / 670	-17.5 -17.5	0.28 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
DL = 3.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.0	PSF	
TOTAL LOAD = 33.3	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCS 2010

THIS DESIGN COMPLIES WITH:
 - PART 9 OF OBC 2012, BCBC 2012, ABC 2014
 - CSA 086-09
 - TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.67")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
 ALLOWABLE DEFL.(TL)= L/360 (0.67")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.20/1.00 (2-3:1), BC=0.28/1.00 (8-10:4), WB=0.65/1.00 (3-12:1), SSI=0.13/1.00 (4-5:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (11) (INPUT = 0.90)
 JSI METAL= 0.38 (3) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



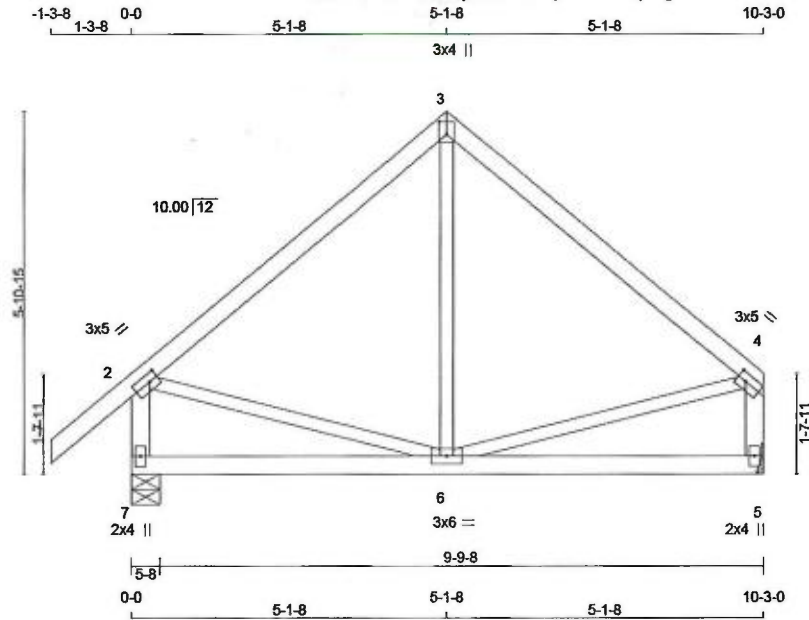

Scale = 1:35.8

TOTAL WEIGHT = 3 X 44 = 133 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
1 - 3	2x4	DRY	No.2	SPF
3 - 4	2x4	DRY	No.2	SPF
7 - 2	2x4	DRY	No.2	SPF
5 - 4	2x4	DRY	No.2	SPF
7 - 5	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMVW-t	MT20	3.0	5.0	1.50	1.75
3	TTW+p	MT20	3.0	4.0	2.50	1.50
4	TMVW-t	MT20	3.0	5.0	1.50	1.75
5	BMV1+p	MT20	2.0	4.0		
6	BMVW-t	MT20	3.0	6.0		
7	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQRD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ
7	593	0	593	0
5	486	0	486	0

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT 5 TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
7	414	303 / 0	0 / 0	0 / 0	111 / 0	0 / 0
5	341	239 / 0	0 / 0	0 / 0	103 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 7

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1 MAX	MAX. UNBRAC	MEMB.	WEBS	MAX. FACTORED
		(LBS)	(PLF)		CSI (LC)	LENGTH			(LBS)
FR-TO							FR-TO		
1-2		0 / 34	-77.4	-77.4	0.11 (1)	10.00	6-3		-8 / 86
2-3		-303 / 0	-77.4	-77.4	0.26 (1)	6.25	2-6		0 / 241
3-4		-303 / 0	-77.4	-77.4	0.26 (1)	6.25	6-4		0 / 241
7-2		-559 / 0	0.0	0.0	0.06 (1)	7.81			
5-4		-452 / 0	0.0	0.0	0.05 (1)	7.81			
7-6		0 / 0	-17.5	-17.5	0.13 (4)	10.00			
6-5		0 / 0	-17.5	-17.5	0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 3.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.0	PSF
TOTAL LOAD	= 33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.34")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.34")
CALCULATED VERT. DEFL.(TL)= L/999 (0.02")

CSI: TC=0.26/1.00 (2-3:1), BC=0.13/1.00 (5-6:4),
WB=0.05/1.00 (2-6:1), SS=0.12/1.00 (2-3:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.49 (4) (INPUT = 0.90)
JSI METAL= 0.15 (2) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.





BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B37579H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON	3.00	0.144	132	147
WIRE	3.25	0.144	132	147
	3.50	0.160	159	177

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to **wind** the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-09, section 10.9.4
10. This design is not valid after April 30, 2019.

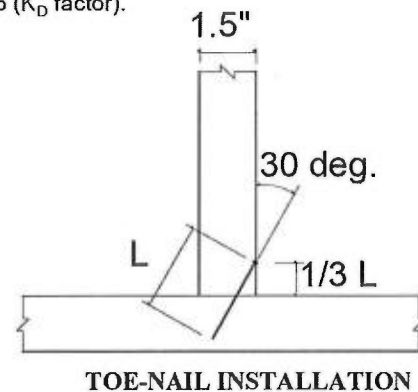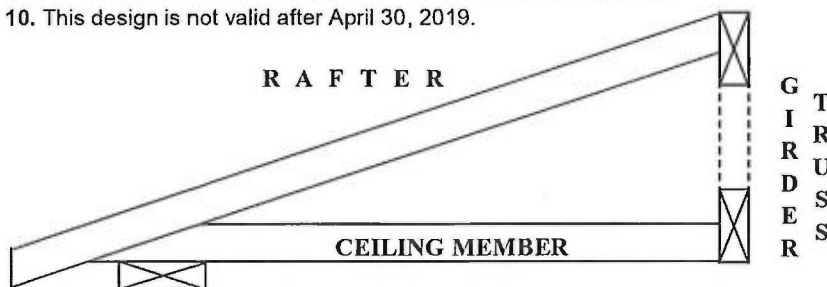

Nail type	Common wire	Common spiral	Common wire
Nail dia. (in)	0.160	0.152	0.144
	(3.5" nail)		(3" and 3.25" nail)
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS		
2X4 SPF	2	2	3
2X4 D. Fir	2	2	2
2X6 SPF	4	4	4
2X6 D. Fir	3	3	3



MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

PEO
Certificate No. 10889485



April 26, 2017

BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B37579H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind or earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.5.2.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-09, section 10.9.5
9. This design is not valid after April 30, 2019

Toe-nailing on 2x6 Bearing Plate

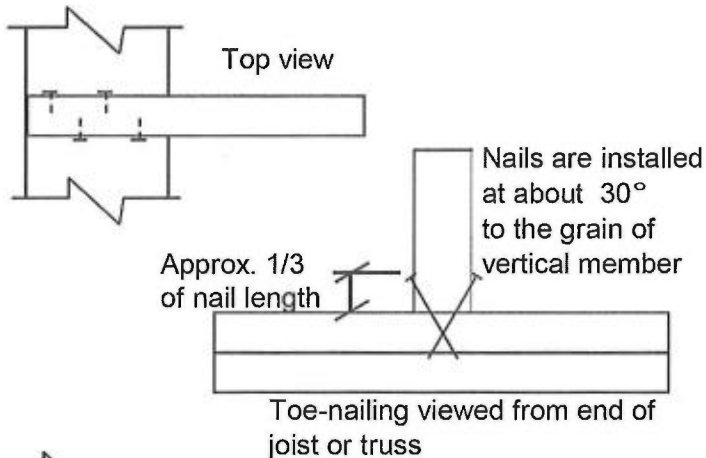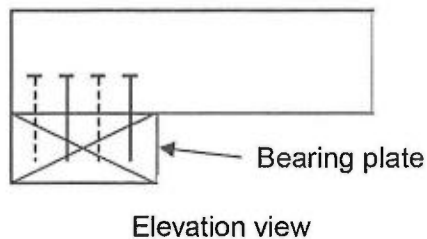

Toe-nailing on 2x4 Bearing Plate

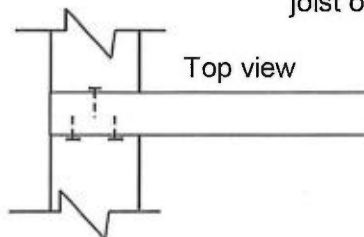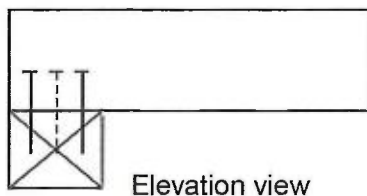

MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

PEO
Certificate No. 10889485



April 26, 2017

For conventional wood framing
framing shall conform to OBC.9.23

All work shall conform to the Ontario
Building Code O. Reg. 332/12 as amended

CITY OF BRAMPTON
BUILDING DIVISION
REVIEWED
JAN 17 2019
BY
MARK DERKSEN


PAGE 2 OF 40



Layout based on plans provided by
VA3 DESIGN
Dated May 30/18

THIS CERTIFICATION IS FOR THE ENGINEERING REVIEW OF
STRUCTURAL COMPONENTS SHOWN ON THIS DRAWING
AND IS LIMITED TO THE COMPONENTS SUPPLIED BY KOTT
LUMBER FOR THE LOADS AND CONDITIONS SHOWN ON
THE CALCULATION PAGE OF EACH COMPONENT. THE
PLACEMENT OF THESE COMPONENTS ON THIS LAYOUT IS
SHOWN FOR REFERENCE ONLY. ROOF TRUSSES MUST BE
INSTALLED ACCORDING TO MANUFACTURER'S GUIDELINES
AT 24" C/C UNLESS NOTED OTHERWISE. CONVENTIONAL
FRAMING SHOWN ON THE LAYOUT MUST BE DESIGNED
AND APPROVED BY THE PROJECT ENGINEER. TEMPORARY
AND PERMANENT BRACINGS OF THE ROOF AND BUILDING
ARE THE RESPONSIBILITY OF THE PROJECT ENGINEER
AND TO CONFORM TO BCSI GUIDELINES.

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.

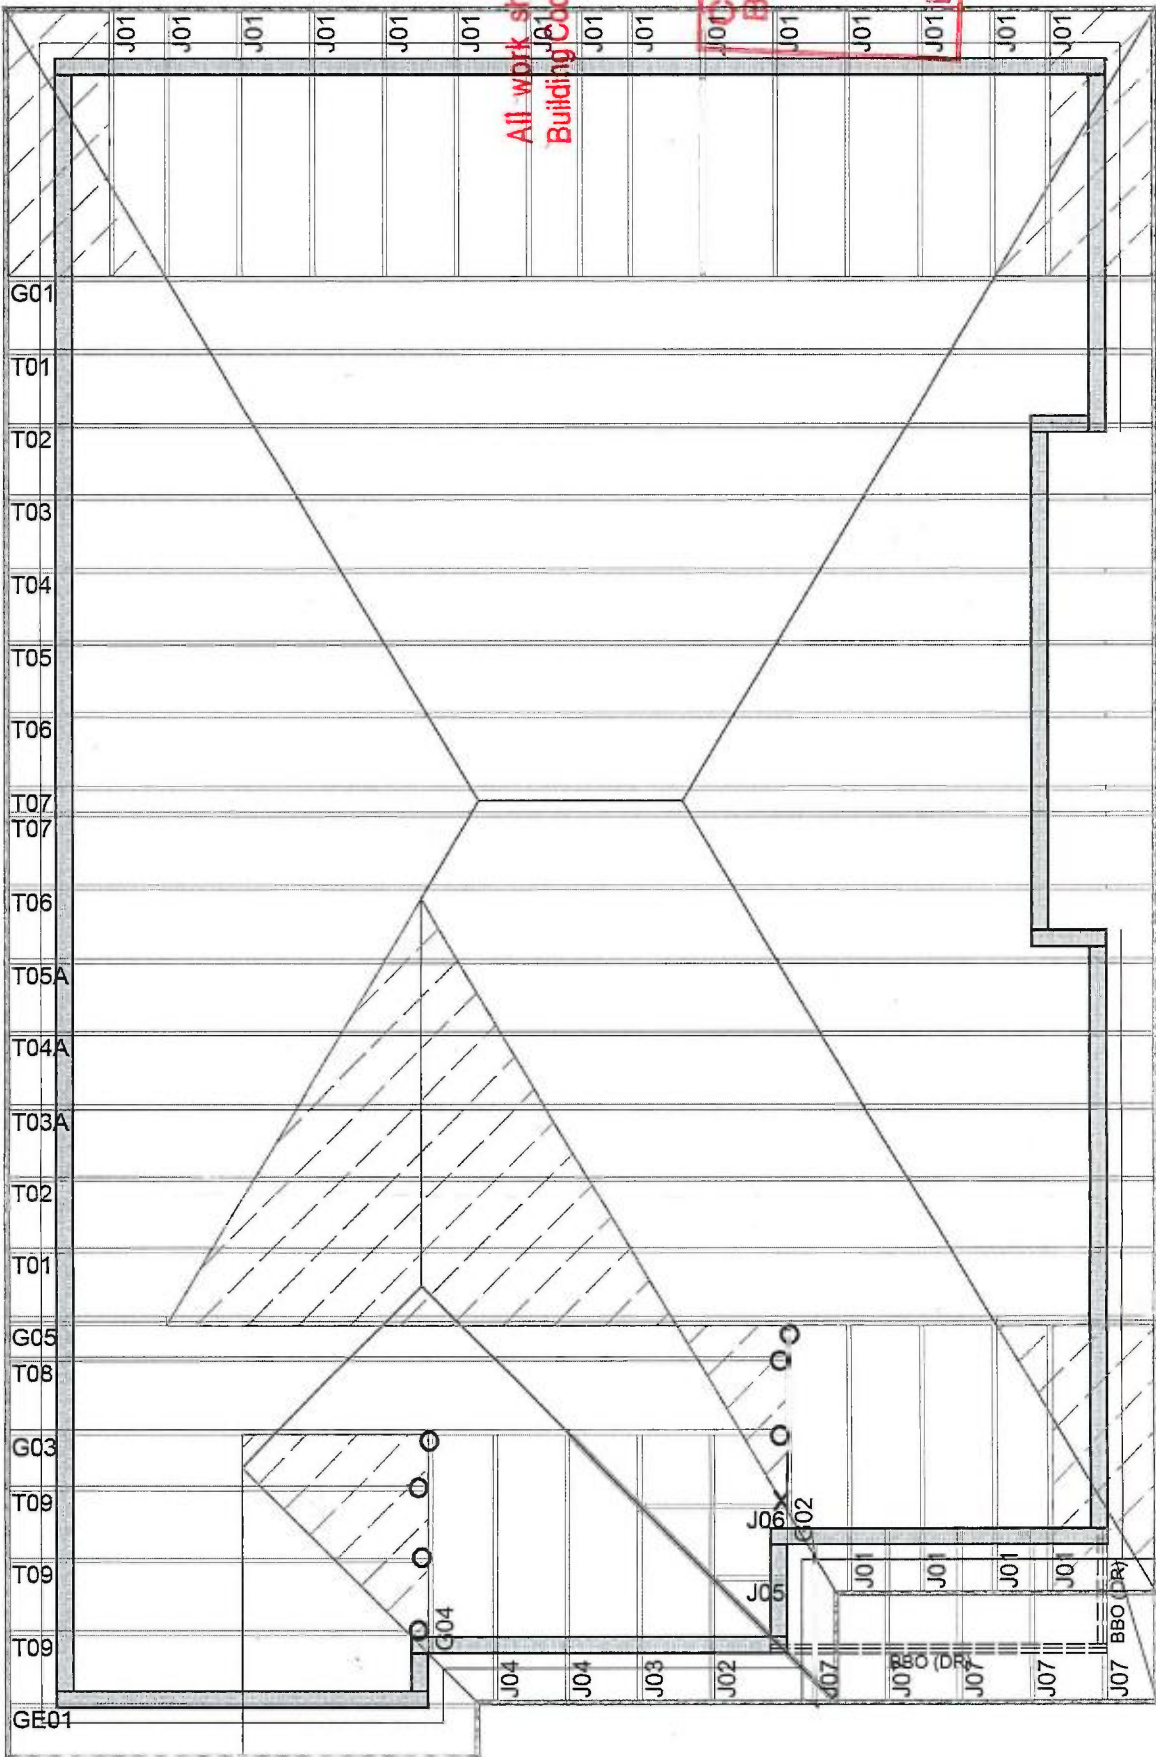

FLAT ROOF BELOW
BY OTHERS

ROOF TRUSS LAYOUT



CONVENTIONAL
FRAMING BY OTHERS

SIZE AND LOCATION OF CONVENTIONAL FRAMING IS APPROXIMATE. ALL AREAS
MAY NOT BE SHOWN. REFER TO ARCHITECTURAL PLANS FOR DETAILS.

ALL CONVENTIONAL FRAMING TO CONFORM WITH PART 9 OF THE O.B.C RAFTER THAT
CROSS MEET OVER TRUSSES TO BE 2X4 SPF @ 24" O/C WITH 2X4 VERT POST TO THE
TRUSS BELOW EA CROSS PT. VERT POS. THAN 6" TO HAVE A LATERAL BRACING SO THAT
THE DISTANCE BETEN PT & VERT ROWS OF BRACING DOES NOT EXCEED 6'

HANGER LEGEND

X - LUS24
- HGUS26

O - LJS26DS
% - HGUS26-2

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 23.3 psf
DL = 3.0 psf
BOT CH. LL = 0.0 psf
DL = 7.0 psf
TOTAL LOAD = 33.3 psf

SPACING @ 24" CENTERS.
THIS TRUSS SYSTEM IS DESIGN FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH PART 9 OF OBC 2012,
BCBC 2012, ABC 2012, CSA 086-09, TPIC 2011

ALLOWABLE DEFLECTION OF EACH COMPONENT = L/360

Model:	MILLWOOD 3 EL 1
Customer:	GREENPARK
Project:	MINNISALE HOMES
Location:	BRAMPTON
Drawn By:	DM
Date:	6/25/2018

1018782
18-333300-000-00 RR-ROOF