

NE0818-098
GREENPARK-MINNISALE
HOMES-HEMLOCK 3 EL 1

Lot 12 L
ENGINEERING NOTE PAGE (ENP-1)
PLEASE READ PRIOR TO INSTALLATION
19-440065.000.00 RR
M2060

RESPONSIBILITIES

THIS DESIGN IS FOR AN INDIVIDUAL BUILDING COMPONENT AND HAS BEEN BASED ON INFORMATION PROVIDED BY THE DESIGN OFFICE OF KOTT LUMBER. THE UNDERSIGNED ENGINEER DISCLAIMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF FAULTY OR INCORRECT INFORMATION, SPECIFICATION AND/OR DESIGNS FURNISHED TO THE ENGINEER. THE UNDERSIGNED ENGINEER IS ONLY RESPONSIBLE FOR THE STRUCTURAL INTEGRITY OF THIS BUILDING COMPONENT FOR THE CONDITIONS AND LOADS SHOWN ON THIS DRAWING. THE STRUCTURAL INTEGRITY OF THE BUILDING AND THE VERIFICATION OF THE DIMENSIONS AND THE DESIGN LOADS USED ARE THE RESPONSIBILITY OF THE BUILDING DESIGNER.

TRUSSES ARE DESIGNED IN CONFORMANCE WITH THE RELEVANT SECTIONS OF THE NATIONAL BUILDING CODE OF CANADA OR THE CANADIAN CODE FOR FARM BUILDINGS, WHICHEVER APPLIES TO THE BUILDING TYPE INDICATED ON THE DRAWING

IT IS THE RESPONSIBILITY OF KOTT LUMBER TO ENSURE THAT TRUSSES ARE MANUFACTURED IN CONFORMANCE WITH THESE DESIGNS AND WITH THE SPECIFICATIONS OUTLINED BELOW. THE UNDERSIGNED ENGINEER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

USE AND OCCUPANCY

- The building is of the type indicated on the drawing

LOADING

- The truss loading intensity and distribution as well as load transfer mechanism is that indicated on the drawing
- No buildings, trees, parapets or other projections higher than the roof for which the trusses are used are located within a distance less than ten (10) times the difference in height, or five metres (16 ft) whichever is greater, unless the drawing indicates that the snow drifting has been taken into account

HANDLING, INSTALLATION AND BRACING


- The trusses must be handled and installed by a qualified professional as per the supplied document titled *Information for Truss Installers* and the BCSI-B1 and BCSI-B3 Summary Sheets
- The compression chords are laterally braced by continuous rigid diaphragm sheathing or as specified on the drawing
- Temporary and permanent bracing must be installed as indicated on the truss drawing and according to the BCSI-B1 and BCSI-B3 Summary Sheets. Bracing for the lateral stability of the truss is to be provided by the building designer
- **It is recommended that a Professional Engineer's advice be obtained for the bracing of trusses spanning more than 12.37m (40'-7")**

SUPPORTS

- The trusses are to be supported at the bearing points indicated and anchored to the supports where considered necessary by the designer of the overall structure
- Bearing sizes shown are the minimum required to prevent crushing of the truss members and do not necessarily take into account stability of the overall building structure
- Elevation of bearings must be carefully checked and shimmed to alignment for solid bearings
- Adequate wood truss bearing is the responsibility of the building designer.

DIMENSIONS

- Geometry of the truss and dimensions indicated on the drawing are identical to those of the installed truss.

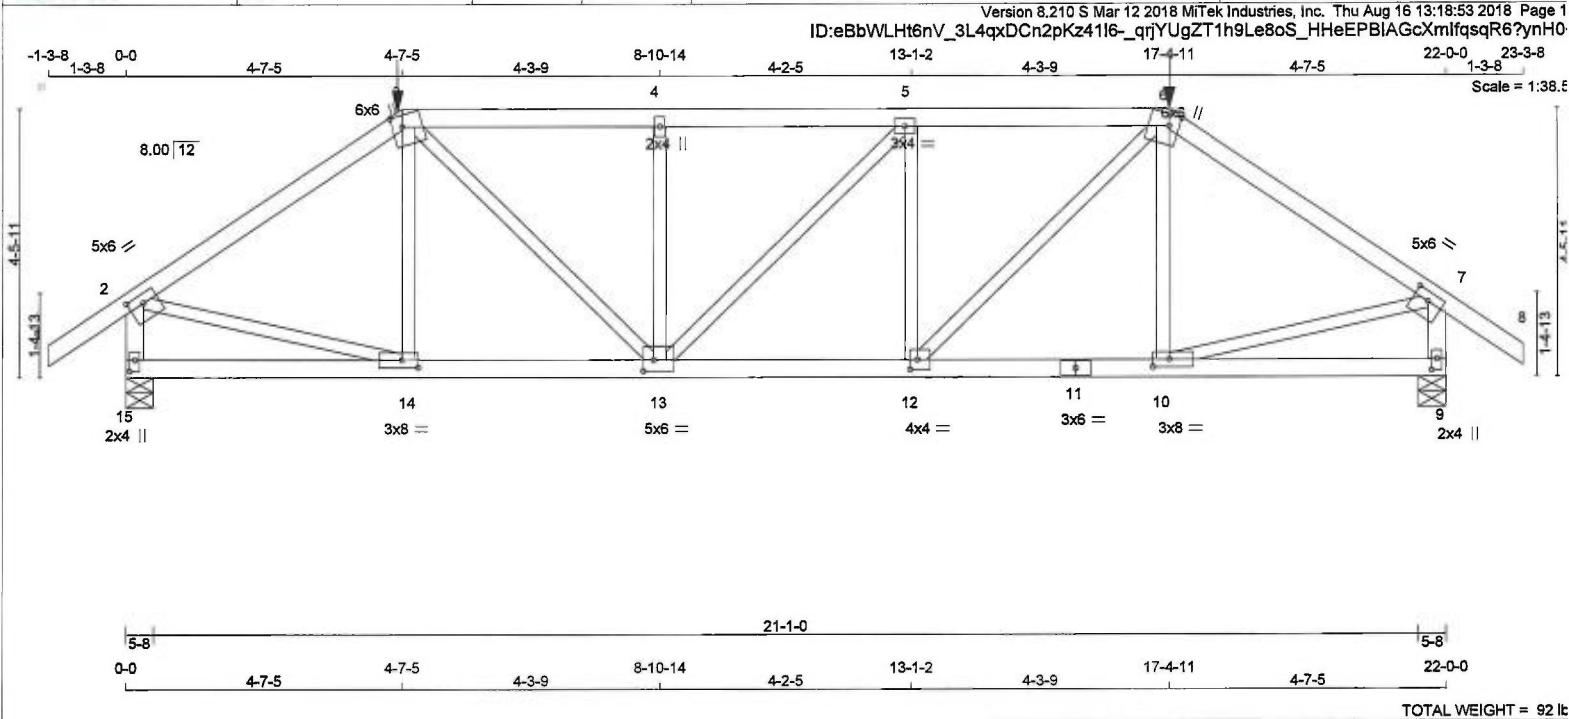

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR.
1 - 3 2x4 DRY No.2 SPF
2 - 6 2x4 DRY No.2 SPF
6 - 8 2x4 DRY No.2 SPF
15 - 2 2x4 DRY No.2 SPF
9 - 7 2x4 DRY No.2 SPF
15 - 11 2x4 DRY No.2 SPF
11 - 9 2x4 DRY No.2 SPF
ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
DRY: SEASONED LUMBER.

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF
SPACING = 24.0 IN. C/C
LOADING IN FLAT SECTION BASED ON A
SLOPE OF 2.00/12 MINIMUM
GIRDER TYPE: CPrimeHip
SIDE SETBACK = 4-7-5
END SETBACK = 6-0-0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADD'L LOADS BASED ON 55 % OF GSL.
THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010
THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011
(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F.
RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED
ROOF LIVE LOAD
ALLOWABLE DEFL.(LL)= L/360 (0.73")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL)= L/360 (0.73")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")
CSI: TC=0.51/1.00 (5-6:1), BC=0.54/1.00 (12-13:1)
, WB=0.47/1.00 (2-14:1), SSI=0.32/1.00 (5-6:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00
COMPANION LIVE LOAD FACTOR = 0.50
TRUSS PLATE MANUFACTURER IS NOT
RESPONSIBLE FOR QUALITY CONTROL IN
THE TRUSS MANUFACTURING PLANT .
NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER
BEARINGS
FACTORED GROSS REACTION MAXIMUM FACTORED GROSS REACTION INPUT REQRD
JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX
15 2025 0 2025 0 0 5-8 5-8
9 2025 0 2025 0 0 5-8 5-8
UNFACTORED REACTIONS
1ST LCASE MAX/MIN. COMPONENT REACTIONS
JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL
15 1420 1001/0 0/0 0/0 0/0 419/0 0/0
9 1420 1001/0 0/0 0/0 0/0 419/0 0/0
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 15, 9
BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.64 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.
LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD LC1 (LC)
FR-TO		FROM TO		FR-TO		FROM TO	
1-2	0/29	-77.4 -77.4	0.11 (1)	10-0	14-3	-257/65	0.08 (1)
2-3	-2245/0	-77.4 -77.4	0.44 (1)	4.09	3-13	0/1141	0.28 (1)
3-4	-2677/0	-145.9 -145.9	0.50 (1)	3.66	13-4	-664/0	0.21 (1)
4-5	-2677/0	-145.9 -145.9	0.51 (1)	3.64	13-5	-4/0	0.00 (1)
5-6	-2680/0	-145.9 -145.9	0.51 (1)	3.64	12-5	-666/0	0.21 (1)
6-7	-2245/0	-77.4 -77.4	0.44 (1)	4.09	12-6	0/1145	0.28 (1)
7-8	0/29	-77.4 -77.4	0.11 (1)	10.00	10-6	-259/65	0.08 (1)
15-2	-1961/0	0.0 0.0	0.22 (1)	5.97	2-14	0/1914	0.47 (1)
9-7	-1961/0	0.0 0.0	0.22 (1)	5.97	10-7	0/1913	0.47 (1)
15-14	0/0	-33.0 -33.0	0.18 (4)	10.00			
14-13	0/1859	-33.0 -33.0	0.43 (1)	10.00			
13-12	0/2680	-33.0 -33.0	0.54 (1)	10.00			
12-11	0/1858	-33.0 -33.0	0.42 (1)	10.00			
11-10	0/1858	-33.0 -33.0	0.42 (1)	10.00			
10-9	0/0	-33.0 -33.0	0.18 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)
JT LOC. LC1 MAX- MAX+ FACE DIR. TYPE
3 4-7-5 -267 -267 -- FRONT VERT TOTAL
6 17-4-11 -267 -267 -- FRONT VERT TOTAL

PLATES (table is in inches)
JT TYPE PLATES W LEN Y X
2 TMVW-t MT20 5.0 6.0 1.75 3.00
3 TTWW+m MT20 6.0 6.0 2.25 2.00
4 TMW+w MT20 2.0 4.0
5 TMWW-t MT20 3.0 4.0
6 TTWW+m MT20 6.0 6.0 2.25 2.00
7 TMVW-t MT20 5.0 6.0 1.75 3.00
9 BMV1+p MT20 2.0 4.0 2.25 1.00
10 BMVW-t MT20 3.0 8.0 1.50 3.25
11 BS-t MT20 3.0 6.0
12 BMVW-t MT20 4.0 4.0 2.00 1.50
13 BMVW-t MT20 5.0 6.0 2.25 2.00
14 BMVW-t MT20 3.0 8.0 1.50 3.25
15 BMV1+p MT20 2.0 4.0 2.25 1.00
HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S)
REQUIRED TO SUPPORT CONCENTRATED
LOAD(S) 267.4 lbs FACTORED DOWN AT
17-4-11, AND 267.4 lbs FACTORED DOWN AT
4-7-5 ON TOP CHORD. DESIGN FOR
UNSPECIFIED CONNECTION(S) IS DELEGATED
TO THE BUILDING DESIGNER.

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.

CONTINUED ON PAGE 2

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.90 (12) (INPUT = 0.90)
JSI METAL= 0.60 (2) (INPUT = 1.00)


READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



JSI GRIP= 0.85 (2) (INPUT = 0.90)
JSI METAL= 0.36 (2) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



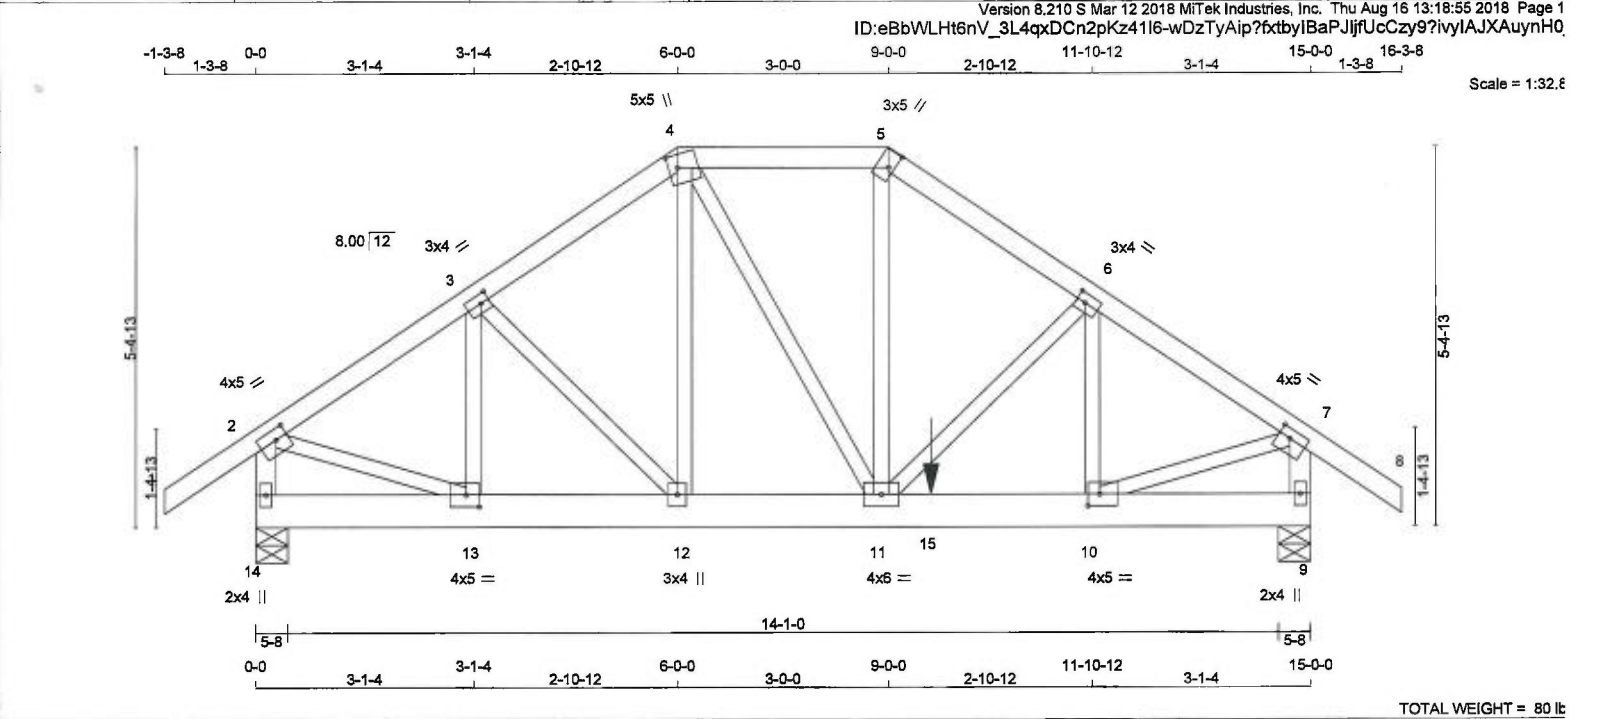

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR.
1 - 4 2x4 DRY No.2 SPF
4 - 5 2x4 DRY No.2 SPF
5 - 8 2x4 DRY No.2 SPF
14 - 2 2x4 DRY No.2 SPF
9 - 7 2x4 DRY No.2 SPF
14 - 9 2x6 DRY No.2 SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER
BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
14	1198	0	1198	0
9	1495	0	1495	0

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
14	839	600 / 0	0 / 0	0 / 0	0 / 0	239 / 0	0 / 0
9	1047	746 / 0	0 / 0	0 / 0	0 / 0	301 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 14, 9

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.50")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL)= L/360 (0.50")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.17/1.00 (7-9:1), BC=0.47/1.00 (10-11:1), WB=0.34/1.00 (7-10:1), SSI=0.58/1.00 (10-11:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

TOTAL WEIGHT = 80 lb [M]

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMVW-t	MT20	4.0	5.0	1.75	2.00
3	TMVW-t	MT20	3.0	4.0	1.50	1.50
4	TTWW+m	MT20	5.0	5.0	2.25	1.50
5	TTW+h	MT20	3.0	5.0	2.75	1.00
6	TMVW-t	MT20	3.0	4.0	1.50	1.50
7	TMVW-t	MT20	4.0	5.0	1.50	2.00
9	BMV1+p	MT20	2.0	4.0		
10	BMVW-t	MT20	4.0	5.0	2.00	2.00
11	BMVWV-t	MT20	4.0	6.0		
12	BMVW-t	MT20	3.0	4.0		
13	BMVW-t	MT20	4.0	5.0	2.00	2.25
14	BMV1+p	MT20	2.0	4.0		

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 1058.7 lbs FACTORED DOWN AT 9-7-4 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

CHORDS

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO		LENGTH	FR-TO		
1-2	0 / 29	-77.4 -77.4	0.11 (1)	10.00	13-3	-267 / 0	0.06 (1)
2-3	-1157 / 0	-77.4 -77.4	0.14 (1)	5.74	3-12	-17 / 0	0.01 (1)
3-4	-1173 / 0	-77.4 -77.4	0.13 (1)	5.71	12-4	-19 / 31	0.01 (4)
4-5	-1229 / 0	-77.4 -77.4	0.15 (1)	5.59	4-11	0 / 535	0.13 (1)
5-6	-1478 / 0	-77.4 -77.4	0.13 (1)	5.24	11-5	0 / 612	0.15 (1)
6-7	-1552 / 0	-77.4 -77.4	0.14 (1)	5.13	11-6	-121 / 0	0.04 (1)
7-8	0 / 29	-77.4 -77.4	0.11 (1)	10.00	10-6	-140 / 8	0.03 (1)
14-2	-1164 / 0	0.0 0.0	0.13 (1)	7.35	2-13	0 / 1023	0.25 (1)
9-7	-1490 / 0	0.0 0.0	0.17 (1)	6.68	10-7	0 / 1366	0.34 (1)
14-13	0 / 0	-17.5 -17.5	0.03 (1)	10.00			
13-12	0 / 974	-17.5 -17.5	0.16 (1)	10.00			
12-11	0 / 961	-17.5 -17.5	0.28 (1)	10.00			
11-15	0 / 1301	-17.5 -17.5	0.47 (1)	10.00			
15-10	0 / 1301	-17.5 -17.5	0.47 (1)	10.00			
10-9	0 / 0	-17.5 -17.5	0.05 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
15	9-7-4	-1059	-1059	-	FRONT	VERT	TOTAL

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

CONTINUED ON PAGE 2


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
NE0818-098	G03	1	1	GREENPARK-MINNISALE HOMES-HEMLOCK 3 EL 1	
				TRUSS DESC.	

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu Aug 16 13:18:55 2018 Page 2
ID:eBbWLHt6nV_3L4qxDCn2pKz41I6-wDzTyAip?ftbYlBaPJlfUcCzy9?IvylAJXAuynH0

PLATE PLACEMENT TOL = 0.250 inches
PLATE ROTATION TOL = 5.0 Deg.
JSI GRIP= 0.90 (7) (INPUT = 0.90)
JSI METAL= 0.50 (7) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



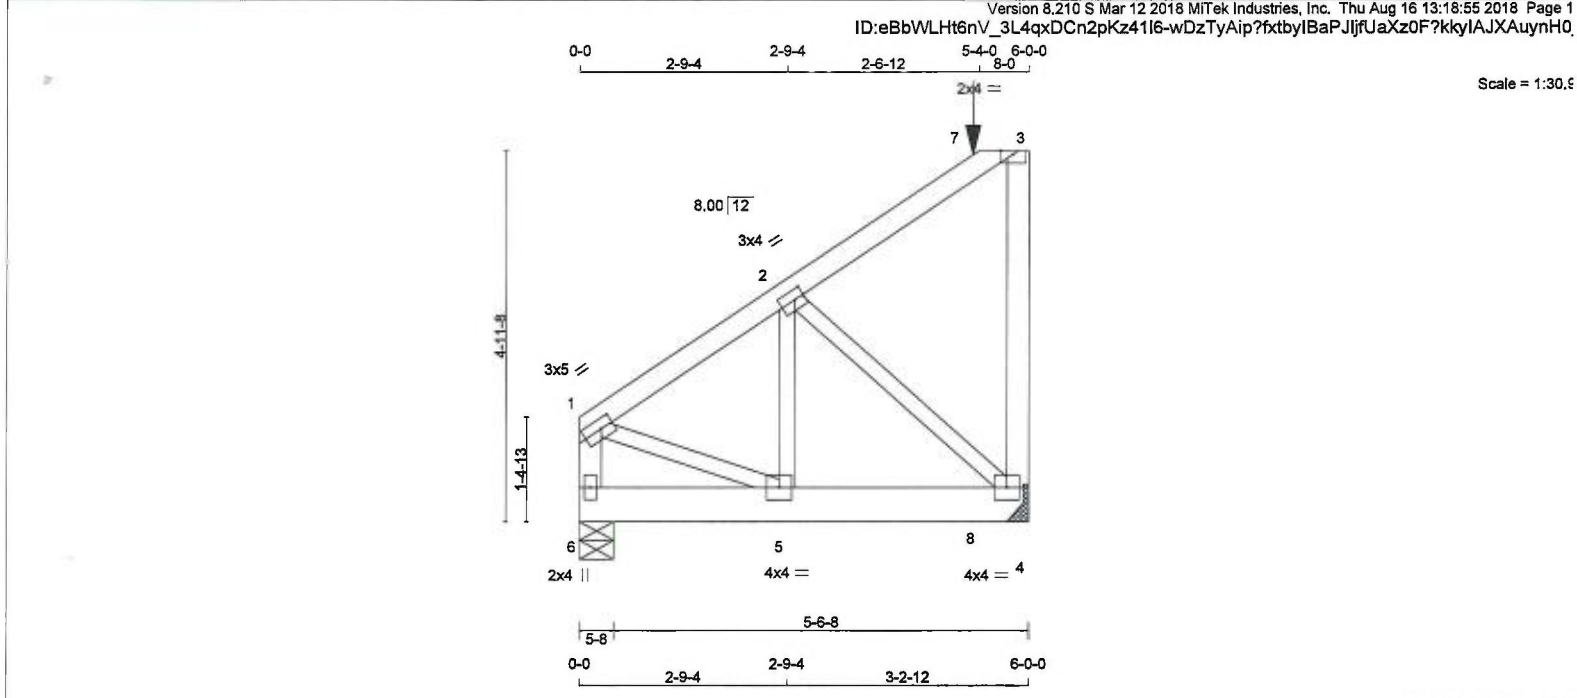

TOTAL WEIGHT = 32 lb [M]

LUMBER		DESCR.			
N. L. G. A. RULES					
CHORDS	SIZE		LUMBER		
1 - 3	2x4	DRY	No.2	SPF	
4 - 3	2x4	DRY	No.2	SPF	
6 - 1	2x4	DRY	No.2	SPF	
6 - 4	2x6	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
1	TMVW-t	MT20	3.0	5.0	1.50	2.00
2	TMWW-t	MT20	3.0	4.0	1.50	1.50
3	TMV-p	MT20	2.0	4.0	Edge	
4	BMVW1-t	MT20	4.0	4.0		
5	BMWW-t	MT20	4.0	4.0		
6	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 283.6 lbs FACTORED DOWN AT 5-4-0 ON TOP CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
		FACTORED		MAXIMUM FACTORED		INPUT	
		GROSS REACTION		GROSS REACTION		BRG	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
4		1061	0	1061	0	0	MECHANICAL
6		856	0	856	0	0	5-8
A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT 4 TO RESIST THE MAX FACTORED REACTIONS.							

UNFACTORED REACTIONS							
		1ST LCASE		MAX./MIN. COMPONENT REACTIONS			
JT		COMBINED	SNOW	LIVE	PERM.LIVE	WIND	SOIL
4		743	528 / 0	0 / 0	0 / 0	0 / 0	215 / 0
6		603	405 / 0	0 / 0	0 / 0	0 / 0	199 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 6

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

CHORDS				WEBS			
		MAX. FACTORED		MAX. FACTORED		MAX. FACTORED	
MEMB.		FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)
FR-TO			FROM TO			FR-TO	
1-2		-646 / 0	-77.4 -77.4	0.19 (1)	6.25	5-2	0 / 494
2-7		0 / 22	-77.4 -77.4	0.27 (1)	6.25	2-4	-744 / 0
7-3		0 / 22	-77.4 -77.4	0.27 (1)	6.25	1-5	0 / 593
4-3		-296 / 0	0.0 0.0	0.13 (1)	7.81		
6-1		-635 / 0	0.0 0.0	0.07 (1)	7.81		
6-5		0 / 0	-198.1 -198.1	0.11 (1)	10.00		
5-8		0 / 558	-198.1 -198.1	0.21 (1)	10.00		
8-4		0 / 558	-198.1 -198.1	0.21 (1)	10.00		

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
7	5-4-0	-264	-264	-	FRONT	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

GIRDER TYPE: CStdGirder
START DISTANCE = 0-0
START SPAN CARRIED = 9-6-8
END DISTANCE = 6-0-0
END SPAN CARRIED = 9-6-8
END WALL WIDTH = 5-8
APPLIED TO BACK SIDE OF BOTTOM CHORD.
- ADDT'L LOADS BASED ON 55 % OF GSL.

GIRDER TYPE: CPrimeHip
LEFT SETBACK = 5-4-0
RIGHT SETBACK = 0-0
END SETBACK = 5-4-0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADDT'L LOADS BASED ON 55 % OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.02")

CSI: TC=0.27/1.00 (2-3:1) , BC=0.21/1.00 (4-5:1) , WB=0.22/1.00 (2-4:1) , SS=0.24/1.00 (4-5:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

CONTINUED ON PAGE 2


READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 822 2284 1656
 PLATE PLACEMENT TOL = 0.250 inches
 PLATE ROTATION TOL = 5.0 Deg.
 JSI GRIP= 0.87 (2) (INPUT = 0.90)
 JSI METAL= 0.21 (1) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
 ENGINEERING NOTE PAGE ENP-1. THIS
 NOTE PAGE IS AN INTEGRAL PART OF
 THIS DRAWING AS IT CONTAINS
 SPECIFICATIONS AND CRITERIA USED IN
 THE DESIGN OF THIS COMPONENT.



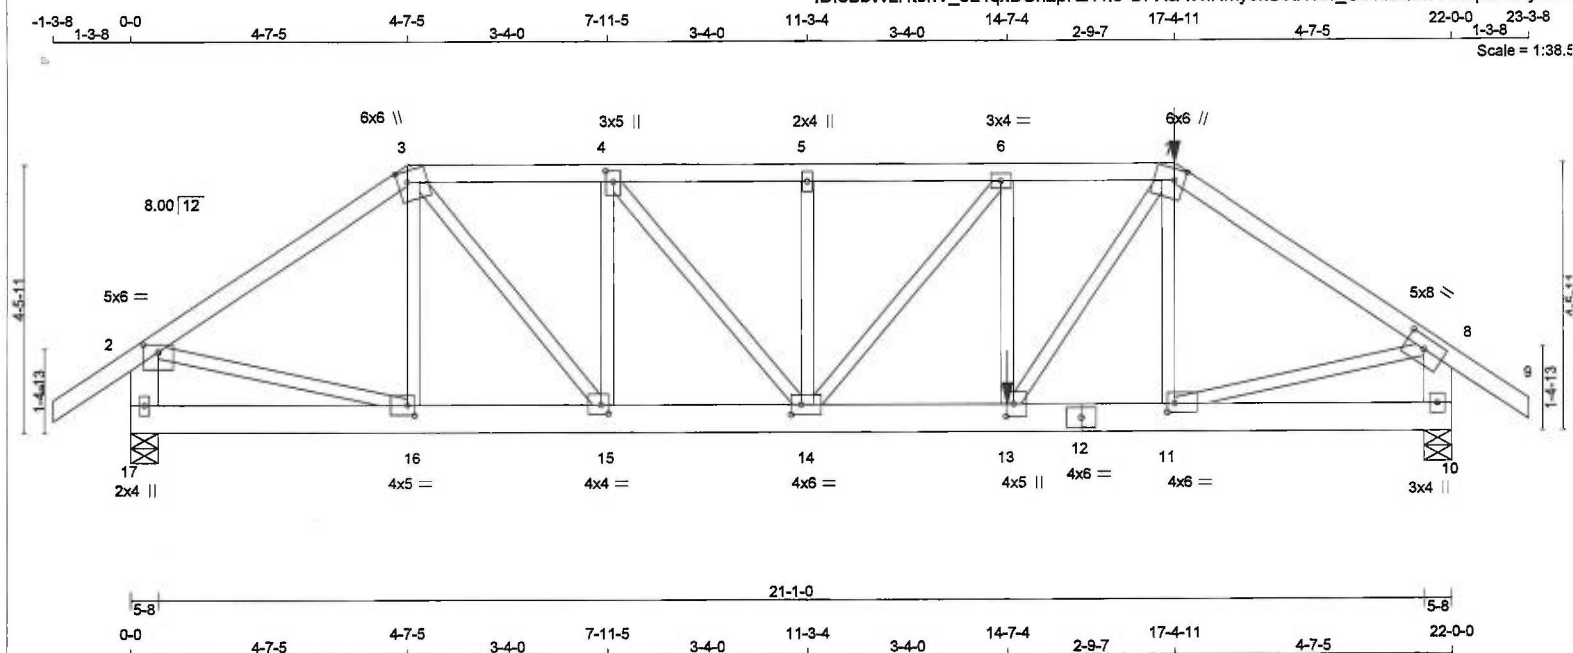

TOTAL WEIGHT = 111 lb [M]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
1 - 3	2x4	DRY	No.2	SPF
3 - 7	2x4	DRY	No.2	SPF
7 - 9	2x4	DRY	No.2	SPF
17 - 2	2x6	DRY	No.2	SPF
10 - 8	2x6	DRY	No.2	SPF
17 - 12	2x6	DRY	No.2	SPF
12 - 10	2x6	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
17	1661	0	1661	0	5-8	5-8
10	2354	0	2354	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
17	1163	830 / 0	0 / 0	0 / 0	0 / 0	333 / 0	0 / 0
10	1651	1160 / 0	0 / 0	0 / 0	0 / 0	492 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 17, 10

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.70 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 MAX. (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LC1 MAX. (LC)	UNBRAC LENGTH
FR-TO				FR-TO			
1-2	0 / 29	-77.4	-77.4 0.11 (1)	10-0	16-3	-239 / 0	0.07 (1)
2-3	-1829 / 0	-77.4	-77.4 0.40 (1)	4-9	3-15	0 / 1243	0.31 (1)
3-4	-2299 / 0	-77.4	-77.4 0.19 (1)	4-32	15-4	-907 / 0	0.26 (1)
4-5	-2809 / 0	-77.4	-77.4 0.23 (1)	3-92	4-14	0 / 808	0.20 (1)
5-6	-2809 / 0	-77.4	-77.4 0.23 (1)	3-92	14-5	-239 / 0	0.07 (1)
6-7	-3066 / 0	-145.9	-145.9 0.28 (1)	3-70	14-6	-408 / 0	0.19 (1)
7-8	-2732 / 0	-77.4	-77.4 0.50 (1)	3-70	13-6	-38 / 51	0.02 (4)
8-9	0 / 29	-77.4	-77.4 0.11 (1)	10-0	13-7	0 / 1425	0.35 (1)
17-2	-1624 / 0	0.0	0.0 0.12 (1)	7-69	11-7	-294 / 41	0.09 (1)
10-8	-2285 / 0	0.0	0.0 0.16 (1)	6-74	2-16	0 / 1553	0.38 (1)
					11-8	0 / 2320	0.57 (1)
17-16	0 / 0	-17.5	-17.5 0.04 (4)	10-0			
16-15	0 / 1513	-17.5	-17.5 0.21 (1)	10-0			
15-14	0 / 2299	-17.5	-17.5 0.34 (1)	10-0			
14-13	0 / 3066	-17.5	-17.5 0.48 (1)	10-0			
13-12	0 / 2262	-33.0	-33.0 0.37 (1)	10-0			
12-11	0 / 2262	-33.0	-33.0 0.37 (1)	10-0			
11-10	0 / 0	-33.0	-33.0 0.08 (4)	10-0			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
7	17-4-11	-267	-267	—	FRONT	VERT	TOTAL
13	14-7-4	-1143	-1143	—	FRONT	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHip
SIDE SETBACK = 4-7-5
END SETBACK = 6-0-0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADDTL LOADS BASED ON 55 % OF GSL.
LOADS APPLIED TO FIRST 7-4-12 OF SPAN
MEASURED FROM THE RIGHT.

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.73")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (0.73")
CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.50/1.00 (7-8:1), BC=0.48/1.00 (13-14:1), WB=0.57/1.00 (8-11:1), SSI=0.20/1.00 (6-7:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (11) (INPUT = 0.90)
JSI METAL= 0.57 (11) (INPUT = 1.00)


READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.





JSI GRIP= 0.13 (5) (INPUT = 0.90)
JSI METAL= 0.06 (5) (INPUT = 1.00)



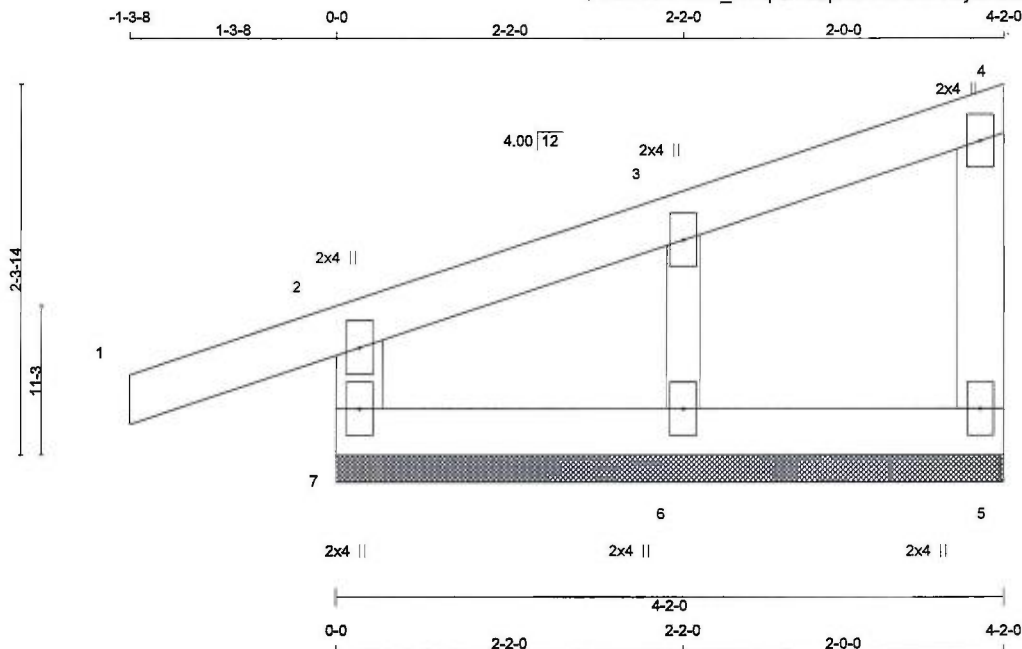

Scale = 1:14.4

TOTAL WEIGHT = 2 X 15 = 30 lb [M]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
7 - 2	2x4	DRY	No.2
1 - 4	2x4	DRY	No.2
5 - 4	2x4	DRY	No.2
7 - 5	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			
GABLE STUDS SPACED AT 2'-0" OC.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	FR-TO
7-2	-190 / 0	0.0	0.0 0.01 (4)	6-3	-167 / 0	0.02 (1)	7.81
1-2	0 / 16	-77.4	-77.4 0.10 (1)				10.00
2-3	-17 / 0	-77.4	-77.4 0.04 (1)				6.25
3-4	-13 / 0	-77.4	-77.4 0.04 (1)				6.25
5-4	-68 / 0	0.0	0.0 0.02 (1)				7.81
7-6	0 / 16	-17.5	-17.5 0.02 (4)				10.00
6-5	0 / 10	-17.5	-17.5 0.02 (4)				10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.10/1.00 (1-2:1), BC=0.02/1.00 (6-7:4), WB=0.02/1.00 (3-6:1), SSI=0.08/1.00 (1-2:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (2) (INPUT = 0.90)
JSI METAL= 0.04 (2) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



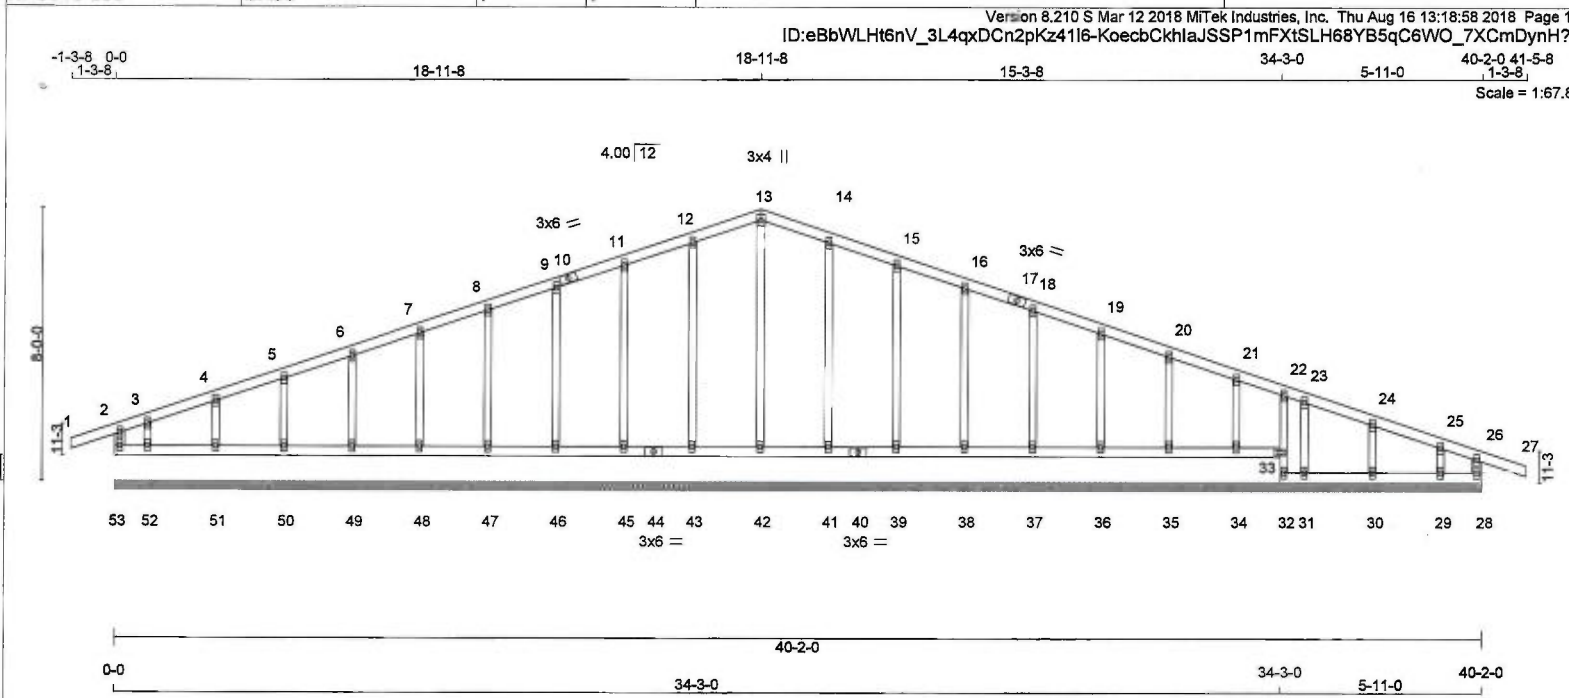

LUMBER N. L. G. A. RULES CHORDS SIZE 53- 2 2x4 DRY No.2 1 - 10 2x4 DRY No.2 10- 13 2x4 DRY No.2 13- 17 2x4 DRY No.2 17- 27 2x4 DRY No.2 28- 26 2x4 DRY No.2 53- 44 2x4 DRY No.2 44- 40 2x4 DRY No.2 40- 33 2x4 DRY No.2 32- 22 2x3 DRY No.2 32- 28 2x4 DRY No.2 ALL WEBS 2x3 DRY No.2 ALL GABLE WEBS 2x3 DRY No.2 DRY: SEASONED LUMBER. GABLE STUDS SPACED AT 2-0-0 OC.		DESCR. SPF SPF SPF SPF SPF SPF SPF SPF SPF SPF SPF SPF SPF SPF		DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 23.3 PSF DL = 3.0 PSF BOT CH. LL = 0.0 PSF DL = 7.0 PSF TOTAL LOAD = 33.3 PSF SPACING = 24.0 IN. C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010 THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012, BCBC 2012, ABC 2014 - CSA 086-09 - TPIC 2011 DESIGN ASSUMPTIONS - OVERHANG NOT TO BE ALTERED OR CUT OFF. (55% OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD CSI: TC=0.10/1.00 (26-27:1), BC=0.03/1.00 (28-29:1), WB=0.16/1.00 (13-42:1), SSI=0.08/1.00 (26-27:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 0.50 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 822 2284 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.82 (13) (INPUT = 0.90) JSI METAL= 0.07 (13) (INPUT = 1.00)		PLATES (table is in inches) JT TYPE PLATES W LEN Y X 2, 22, 26 2 TMV+p MT20 2.0 4.0 3, 4, 5, 6, 7, 8, 9, 11, 12, 14, 15, 16, 18, 19, 20, 21, 23, 24, 25 3 TMW+w MT20 2.0 4.0 10 TS-t MT20 3.0 6.0 13 TTW+p MT20 3.0 4.0 17 TS-t MT20 3.0 6.0 28, 32, 53 28 BMV1+p MT20 2.0 4.0 29, 30, 31, 34, 35, 36, 37, 38, 39, 41, 42, 43, 45, 46, 47, 48, 49, 50, 51, 52 29 BMW1+w MT20 2.0 4.0 33 BVM-I MT20 2.0 4.0 40 BS-t MT20 3.0 6.0 44 BS-t MT20 3.0 6.0		CHORDS MAX. FACTORED MEMB. FORCE (LBS) FR-TO 53- 2 -185 / 0 1- 2 0 / 16 2- 3 -17 / 0 3- 4 0 / 3 4- 5 0 / 4 5- 6 0 / 8 6- 7 0 / 11 7- 8 0 / 13 8- 9 0 / 15 9- 10 0 / 16 10- 11 0 / 16 11- 12 0 / 18 12- 13 0 / 18 13- 14 0 / 18 14- 15 0 / 18 15- 16 0 / 16 16- 17 0 / 15 17- 18 0 / 15 18- 19 0 / 13 19- 20 0 / 10 20- 21 0 / 9 21- 22 0 / 8 22- 23 0 / 2 23- 24 0 / 3 24- 25 0 / 4 25- 26 -14 / 0 26- 27 0 / 16 28- 26 -185 / 0 53- 52 0 / 3 52- 51 0 / 0 51- 50 -5 / 0 50- 49 -8 / 0 49- 48 -10 / 0 48- 47 -12 / 0 47- 46 -14 / 0 46- 45 -15 / 0 45- 44 -16 / 0 44- 43 -16 / 0 43- 42 -18 / 0 42- 41 -18 / 0 41- 40 -16 / 0 40- 39 -16 / 0 39- 38 -15 / 0 38- 37 -14 / 0 37- 36 -12 / 0		WEBS MAX. FACTORED MEMB. FORCE (LBS) FR-TO 42- 13 -169 / 0 43- 12 -157 / 0 44- 9 -154 / 0 45- 8 -154 / 0 46- 7 -154 / 0 47- 6 -154 / 0 48- 5 -151 / 0 49- 4 -164 / 0 50- 3 -151 / 0 51- 2 -157 / 0 52- 1 -154 / 0 53- 0 -154 / 0 54- 0 -154 / 0 55- 0 -154 / 0 56- 0 -154 / 0 57- 0 -154 / 0 58- 0 -154 / 0 59- 0 -154 / 0 60- 0 -154 / 0 61- 0 -154 / 0 62- 0 -154 / 0 63- 0 -154 / 0 64- 0 -154 / 0 65- 0 -154 / 0 66- 0 -154 / 0 67- 0 -154 / 0 68- 0 -154 / 0 69- 0 -154 / 0 70- 0 -154 / 0 71- 0 -154 / 0 72- 0 -154 / 0 73- 0 -154 / 0 74- 0 -154 / 0 75- 0 -154 / 0 76- 0 -154 / 0 77- 0 -154 / 0 78- 0 -154 / 0 79- 0 -154 / 0 80- 0 -154 / 0 81- 0 -154 / 0 82- 0 -154 / 0 83- 0 -154 / 0 84- 0 -154 / 0 85- 0 -154 / 0 86- 0 -154 / 0 87- 0 -154 / 0 88- 0 -154 / 0 89- 0 -154 / 0 90- 0 -154 / 0 91- 0 -154 / 0 92- 0 -154 / 0 93- 0 -154 / 0 94- 0 -154 / 0 95- 0 -154 / 0 96- 0 -154 / 0 97- 0 -154 / 0 98- 0 -154 / 0 99- 0 -154 / 0 100- 0 -154 / 0 101- 0 -154 / 0 102- 0 -154 / 0 103- 0 -154 / 0 104- 0 -154 / 0 105- 0 -154 / 0 106- 0 -154 / 0 107- 0 -154 / 0 108- 0 -154 / 0 109- 0 -154 / 0 110- 0 -154 / 0 111- 0 -154 / 0 112- 0 -154 / 0 113- 0 -154 / 0 114- 0 -154 / 0 115- 0 -154 / 0 116- 0 -154 / 0 117- 0 -154 / 0 118- 0 -154 / 0 119- 0 -154 / 0 120- 0 -154 / 0 121- 0 -154 / 0 122- 0 -154 / 0 123- 0 -154 / 0 124- 0 -154 / 0 125- 0 -154 / 0 126- 0 -154 / 0 127- 0 -154 / 0 128- 0 -154 / 0 129- 0 -154 / 0 130- 0 -154 / 0 131- 0 -154 / 0 132- 0 -154 / 0 133- 0 -154 / 0 134- 0 -154 / 0 135- 0 -154 / 0 136- 0 -154 / 0 137- 0 -154 / 0 138- 0 -154 / 0 139- 0 -154 / 0 140- 0 -154 / 0 141- 0 -154 / 0 142- 0 -154 / 0 143- 0 -154 / 0 144- 0 -154 / 0 145- 0 -154 / 0 146- 0 -154 / 0 147- 0 -154 / 0 148- 0 -154 / 0 149- 0 -154 / 0 150- 0 -154 / 0 151- 0 -154 / 0 152- 0 -154 / 0 153- 0 -154 / 0 154- 0 -154 / 0 155- 0 -154 / 0 156- 0 -154 / 0 157- 0 -154 / 0 158- 0 -154 / 0 159- 0 -154 / 0 160- 0 -154 / 0 161- 0 -154 / 0 162- 0 -154 / 0 163- 0 -154 / 0 164- 0 -154 / 0 165- 0 -154 / 0 166- 0 -154 / 0 167- 0 -154 / 0 168- 0 -154 / 0 169- 0 -154 / 0 170- 0 -154 / 0 171- 0 -154 / 0 172- 0 -154 / 0 173- 0 -154 / 0 174- 0 -154 / 0 175- 0 -154 / 0 176- 0 -154 / 0 177- 0 -154 / 0 178- 0 -154 / 0 179- 0 -154 / 0 180- 0 -154 / 0 181- 0 -154 / 0 182- 0 -154 / 0 183- 0 -154 / 0 184- 0 -154 / 0 185- 0 -154 / 0 186- 0 -154 / 0 187- 0 -154 / 0 188- 0 -154 / 0 189- 0 -154 / 0 190- 0 -154 / 0 191- 0 -154 / 0 192- 0 -154 / 0 193- 0 -154 / 0 194- 0 -154 / 0 195- 0 -154 / 0 196- 0 -154 / 0 197- 0 -154 / 0 198- 0 -154 / 0 199- 0 -154 / 0 200- 0 -154 / 0 201- 0 -154 / 0 202- 0 -154 / 0 203- 0 -154 / 0 204- 0 -154 / 0 205- 0 -154 / 0 206- 0 -154 / 0 207- 0 -154 / 0 208- 0 -154 / 0 209- 0 -154 / 0 210- 0 -154 / 0 211- 0 -154 / 0 212- 0 -154 / 0 213- 0 -154 / 0 214- 0 -154 / 0 215- 0 -154 / 0 216- 0 -154 / 0 217- 0 -154 / 0 218- 0 -154 / 0 219- 0 -154 / 0 220- 0 -154 / 0 221- 0 -154 / 0 222- 0 -154 / 0 223- 0 -154 / 0 224- 0 -154 / 0 225- 0 -154 / 0 226- 0 -154 / 0 227- 0 -154 / 0 228- 0 -154 / 0 229- 0 -154 / 0 230- 0 -154 / 0 231- 0 -154 / 0 232- 0 -154 / 0 233- 0 -154 / 0 234- 0 -154 / 0 235- 0 -154 / 0 236- 0 -154 / 0 237- 0 -154 / 0 238- 0 -154 / 0 239- 0 -154 / 0 240- 0 -154 / 0 241- 0 -154 / 0 242- 0 -154 / 0 243- 0 -154 / 0 244- 0 -154 / 0 245- 0 -154 / 0 246- 0 -154 / 0 247- 0 -154 / 0 248- 0 -154 / 0 249- 0 -154 / 0 250- 0 -154 / 0 251- 0 -154 / 0 252- 0 -154 / 0 253- 0 -154 / 0 254- 0 -154 / 0 255- 0 -154 / 0 256- 0 -154 / 0 257- 0 -154 / 0 258- 0 -154 / 0 259- 0 -154 / 0 260- 0 -154 / 0 261- 0 -154 / 0 262- 0 -154 / 0 263- 0 -154 / 0 264- 0 -154 / 0 265- 0 -154 / 0 266- 0 -154 / 0 267- 0 -154 / 0 268- 0 -154 / 0 269- 0 -154 / 0 270- 0 -154 / 0 271- 0 -154 / 0 272- 0 -154 / 0 273- 0 -154 / 0 274- 0 -154 / 0 275- 0 -154 / 0 276- 0 -154 / 0 277- 0 -154 / 0 278- 0 -154 / 0 279- 0 -154 / 0 280- 0 -154 / 0 281- 0 -154 / 0 282- 0 -154 / 0 283- 0 -154 / 0 284- 0 -154 / 0 285- 0 -154 / 0 286- 0 -154 / 0 287- 0 -154 / 0 288- 0 -154 / 0 289- 0 -154 / 0 290- 0 -154 / 0 291- 0 -154 / 0 292- 0 -154 / 0 293- 0 -154 / 0 294- 0 -154 / 0 295- 0 -154 / 0 296- 0 -154 / 0 297- 0 -154 / 0 298- 0 -154 / 0 299- 0 -154 / 0 300- 0 -154 / 0 301- 0 -154 / 0 302- 0 -154 / 0 303- 0 -154 / 0 304- 0 -154 / 0 305- 0 -154 / 0 306- 0 -154 / 0 307- 0 -154 / 0 308- 0 -154 / 0 309- 0 -154 / 0 310- 0 -154 / 0 311- 0 -154 / 0 312- 0 -154 / 0 313- 0 -154 / 0 314- 0 -154 / 0 315- 0 -154 / 0 316- 0 -154 / 0 317- 0 -154 / 0 318- 0 -154 / 0 319- 0 -154 / 0 320- 0 -154 / 0 321- 0 -154 / 0 322- 0 -154 / 0 323- 0 -154 / 0 324- 0 -154 / 0 325- 0 -154 / 0 326- 0 -154 / 0 327- 0 -154 / 0 328- 0 -154 / 0 329- 0 -154 / 0 330- 0 -154 / 0 331- 0 -154 / 0 332- 0 -154 / 0 333- 0 -154 / 0	
---	--	---	--	---	--	--	--	--	--	--	--

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

LOADING


TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB. FR-TO	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
36-35	-10 / 0	-17.5	-17.5	0.01 (4)	6.25				
35-34	-8 / 0	-17.5	-17.5	0.01 (4)	10.00				
34-33	-5 / 0	-17.5	-17.5	0.01 (4)	10.00				
32-33	-67 / 0	0.0	0.0	0.01 (1)	7.81				
33-22	-54 / 0	0.0	0.0	0.01 (1)	7.81				
32-31	-7 / 0	-17.5	-17.5	0.01 (4)	10.00				
31-30	-5 / 0	-17.5	-17.5	0.02 (4)	10.00				
30-29	0 / 0	-17.5	-17.5	0.02 (4)	10.00				
29-28	0 / 3	-17.5	-17.5	0.03 (1)	10.00				

READ ALL NOTES ON THIS PAGE AND ON
 ENGINEERING NOTE PAGE ENP-1. THIS
 NOTE PAGE IS AN INTEGRAL PART OF
 THIS DRAWING AS IT CONTAINS
 SPECIFICATIONS AND CRITERIA USED IN
 THE DESIGN OF THIS COMPONENT.



Scale = 1:23.4

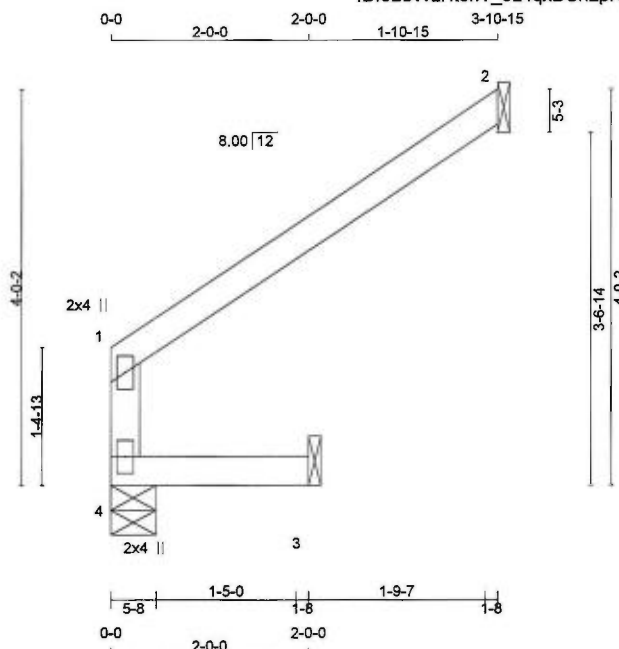

TOTAL WEIGHT = 9 lb [M/JF]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
4 - 1	2x4	DRY	No.2	SPF
1 - 2	2x4	DRY	No.2	SPF
4 - 3	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQRD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
4	152	0	152	0	5-8	5-8
2	134	0	134	0	1-8	1-8
3	52	0	52	0	1-8	1-8

SEE MITK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) 2, 3

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS				
		SNOW	LIVE	PERM. LIVE	WIND	DEAD
4	106	81 / 0	0 / 0	0 / 0	0 / 0	25 / 0
2	91	80 / 0	0 / 0	0 / 0	0 / 0	11 / 0
3	37	21 / 0	0 / 0	0 / 0	0 / 0	16 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 4

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	CHORDS		MAX. UNBRACED LENGTH	WEBS
			FR-TO	TO		
4-1	-169 / 0	0.0	0.0	0.08 (1)	7.81	
1-2	-10 / 0	-77.4	-77.4	0.15 (1)	10.00	
4-3	0 / 0	-17.5	-17.5	0.09 (1)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 3.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.0	PSF
TOTAL LOAD	= 33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.15/1.00 (1-2:1), BC=0.09/1.00 (3-4:1), WB=0.00/1.00 (n/a:0), SSI=0.11/1.00 (1-2:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.11 (1) (INPUT = 0.90)
JSI METAL= 0.04 (1) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



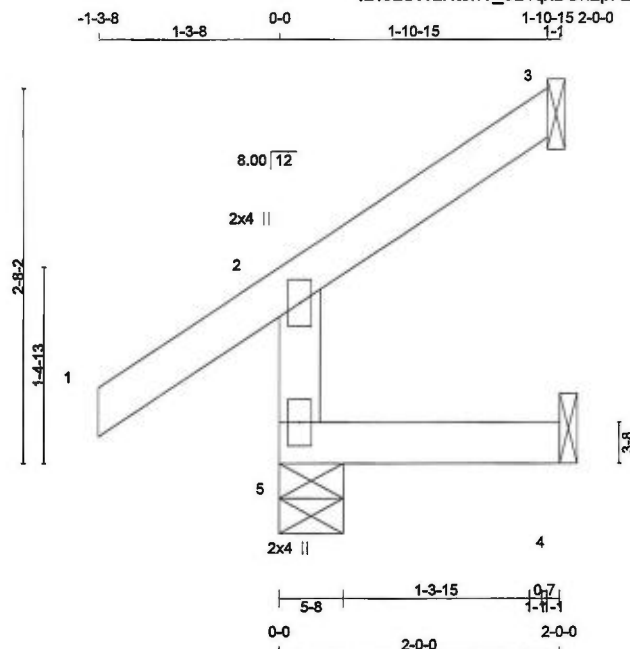

Scale = 1:16.5

TOTAL WEIGHT = 8 lb

LUMBER				LUMBER			
N. L. G. A. RULES				DESCR.			
CHORDS	SIZE			SPF			
5 - 2	2x4	DRY	No.2	SPF			
1 - 3	2x4	DRY	No.2	SPF			
5 - 4	2x4	DRY	No.2	SPF			

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
5	235	0		235	0	0	5-8	5-8	
3	43	0		43	0	-21	1-8	1-8	
4	10	0		18	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) 3, 4

PROVIDE ANCHORAGE AT BEARING JOINT 3 FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

		MAX./MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
5	162	131 / 0	0 / 0	0 / 0	0 / 0	31 / 0	0 / 0	
3	30	25 / -16	0 / 0	0 / 0	0 / 0	4 / 0	0 / 0	
4	9	0 / -7	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 5, 3

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	FACTORED LC1 MAX CSI (LC)
FR-TO		FROM	TO	FR-TO			
5-2	-211 / 0	0.0	0.0 0.03 (5)	7.81			
1-2	0 / 29	-77.4	-77.4 0.10 (1)	10.00			
2-3	-17 / 0	-77.4	-77.4 0.08 (1)	6.25			
5-4	0 / 0	-17.5	-17.5 0.03 (5)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 3.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.0	PSF
TOTAL LOAD	= 33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.10/1.00 (1-2:1), BC=0.03/1.00 (4-5:5),
WB=0.00/1.00 (n/a:0), SSI=0.07/1.00 (1-2:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (2) (INPUT = 0.90)
JSI METAL= 0.05 (2) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



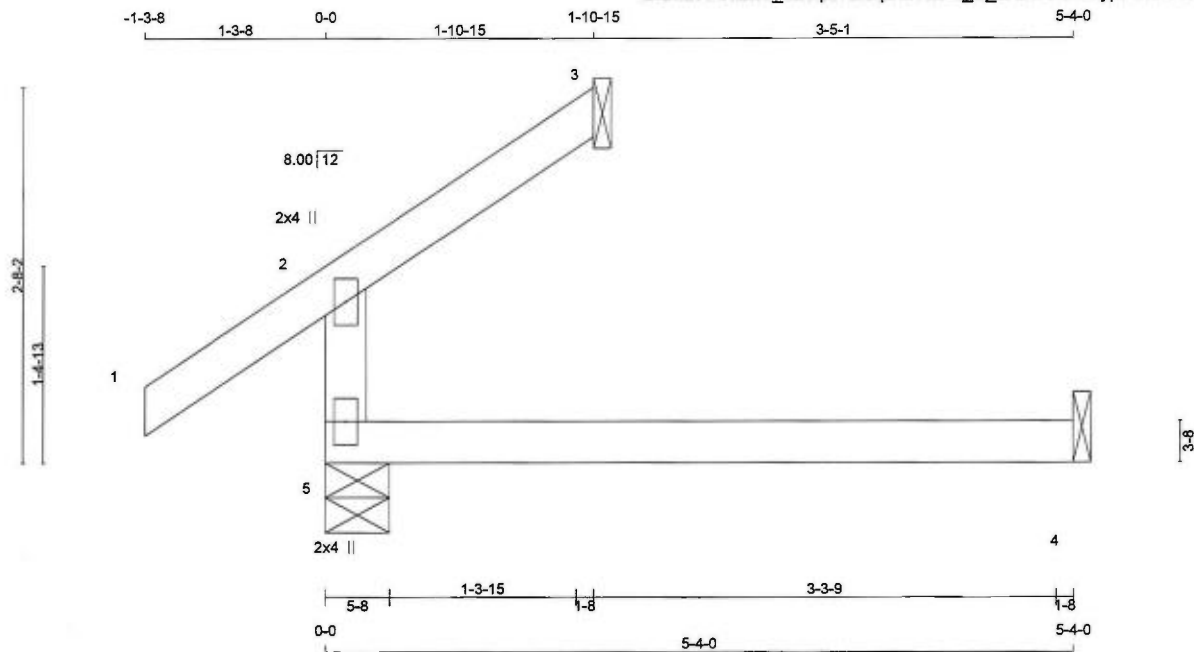

Scale = 1:16.5

TOTAL WEIGHT = 12 lb [M]

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR.
5 - 2 2x4 DRY No.2 SPF
1 - 3 2x4 DRY No.2 SPF
5 - 4 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
5	252	0	252	0	5-8	5-8
3	56	0	56	0	1-8	1-8
4	39	0	46	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) 3, 4

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
5	176	130 / 0	0 / 0	0 / 0	0 / 0	46 / 0	0 / 0
3	40	24 / 0	0 / 0	0 / 0	0 / 0	16 / 0	0 / 0
4	32	0 / -1	0 / 0	0 / 0	0 / 0	33 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 5, 3

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO			FR-TO			
5-2	-198 / 0	0.0	0.0	0.07 (4)	7.81			
1-2	0 / 29	-77.4	-77.4	0.10 (1)	10.00			
2-3	-10 / 8	-77.4	-77.4	0.06 (4)	10.00			
5-4	0 / 0	-17.5	-17.5	0.11 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.10/1.00 (1-2:1), BC=0.11/1.00 (4-5:4), WB=0.00/1.00 (n/a:0), SSI=0.07/1.00 (4-5:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.13 (2) (INPUT = 0.90)
JSI METAL= 0.05 (2) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



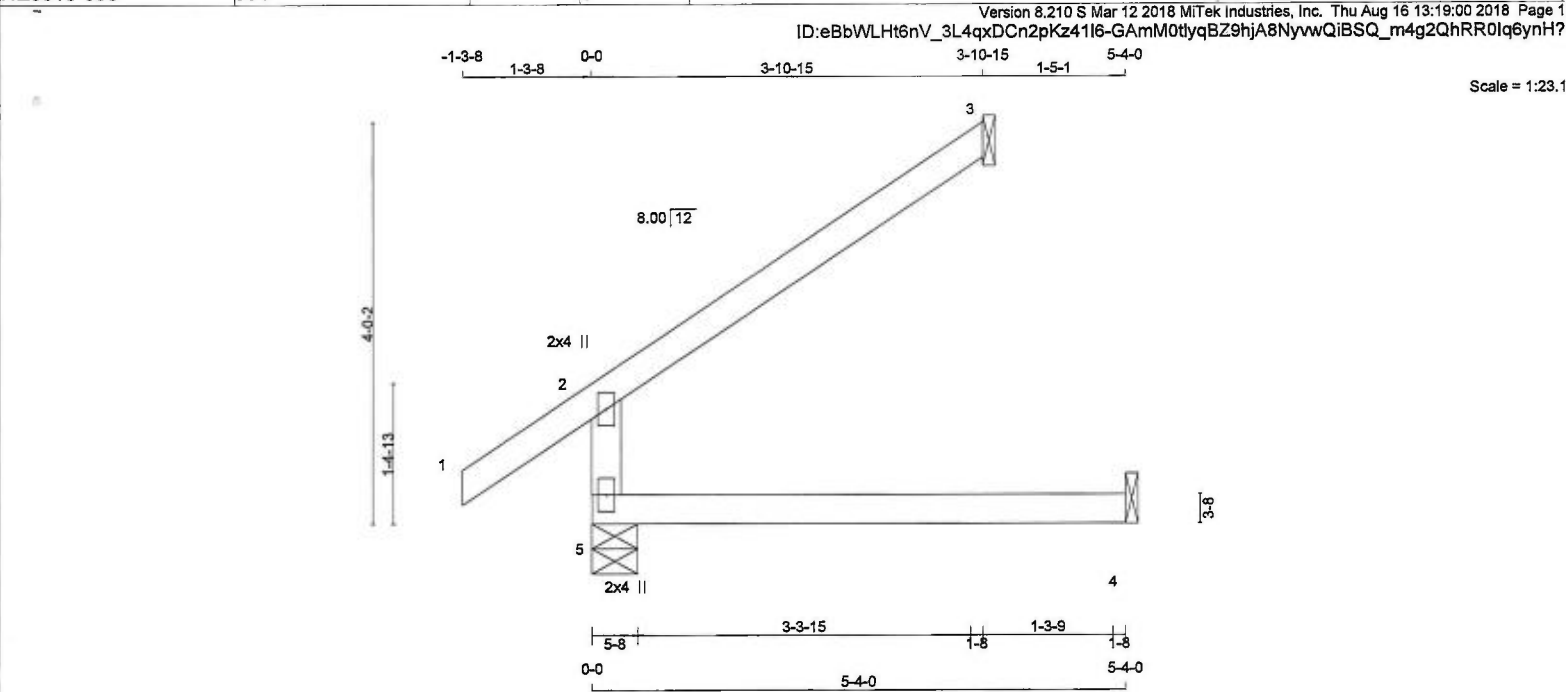

TOTAL WEIGHT = 15 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
5 - 2	2x4	DRY	No.2	
1 - 3	2x4	DRY	No.2	
5 - 4	2x4	DRY	No.2	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMV+p	MT20	2.0	4.0		
5	BMV1+p	MT20	2.0	4.0		

DESCR.
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ
5	349	0	349	0
3	114	0	114	0
4	39	0	44	0

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) 3, 4

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
5	244	178 / 0	0 / 0	0 / 0	0 / 0	66 / 0	0 / 0
3	77	68 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
4	32	0 / 0	0 / 0	0 / 0	0 / 0	32 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 5, 3

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX
FR-TO		FROM	TO		FR-TO		FROM	TO
5-2	-295 / 0	0.0	0.0	0.09 (4)	7.81			
1-2	0 / 29	-77.4	-77.4	0.10 (1)	10.00			
2-3	-21 / 0	-77.4	-77.4	0.20 (1)	6.25			
5-4	0 / 0	-17.5	-17.5	0.10 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL)= L/360 (0.19")

CALCULATED VERT. DEFL.(TL) = L/ 999 (0.02")

CSI: TC=0.20/1.00 (2-3:1), BC=0.10/1.00 (4-5:4),
WB=0.00/1.00 (n/a:0), SSI=0.12/1.00 (2-3:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2264 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.19 (2) (INPUT = 0.90)

JSI METAL= 0.07 (2) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

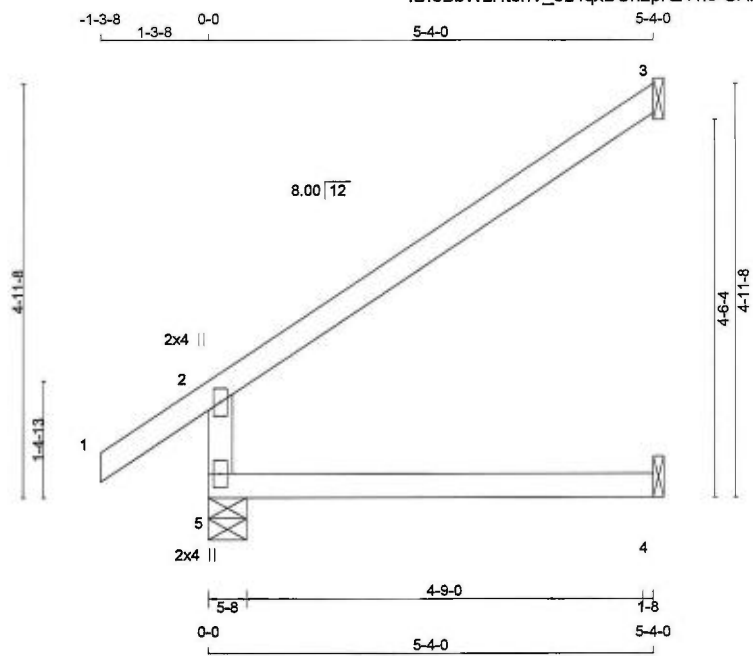

TOTAL WEIGHT = 16 lb
[M]

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER
5 - 2 2x4 DRY No.2
1 - 3 2x4 DRY No.2
5 - 4 2x4 DRY No.2

DESCR.
SPF
SPF
SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMV+p	MT20	2.0	4.0		
5	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ
5	418	0	418	0
3	155	0	155	0
4	39	0	44	0

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) 3 , 4

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
5	291	219 / 0	0 / 0	0 / 0	0 / 0	71 / 0	0 / 0
3	105	93 / 0	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0
4	32	0 / 0	0 / 0	0 / 0	0 / 0	32 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 5

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	UNBRAC LENGTH	MAX. MEMB. FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX (LC)	
FR-TO		FROM TO						
5-2	-364 / 0	0.0	0.0	0.09 (4)	7.81			
1-2	0 / 29	-77.4	-77.4	0.10 (1)	10.00			
2-3	-29 / 0	-77.4	-77.4	0.37 (1)	6.25			
5-4	0 / 0	-17.5	-17.5	0.10 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , CBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.02")

CSI: TC=0.37/1.00 (2-3:1) , BC=0.10/1.00 (4-5:4) ,
WB=0.00/1.00 (n/a:0) , SSI=0.17/1.00 (2-3:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.23 (2) (INPUT = 0.90)
JSI METAL= 0.09 (2) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



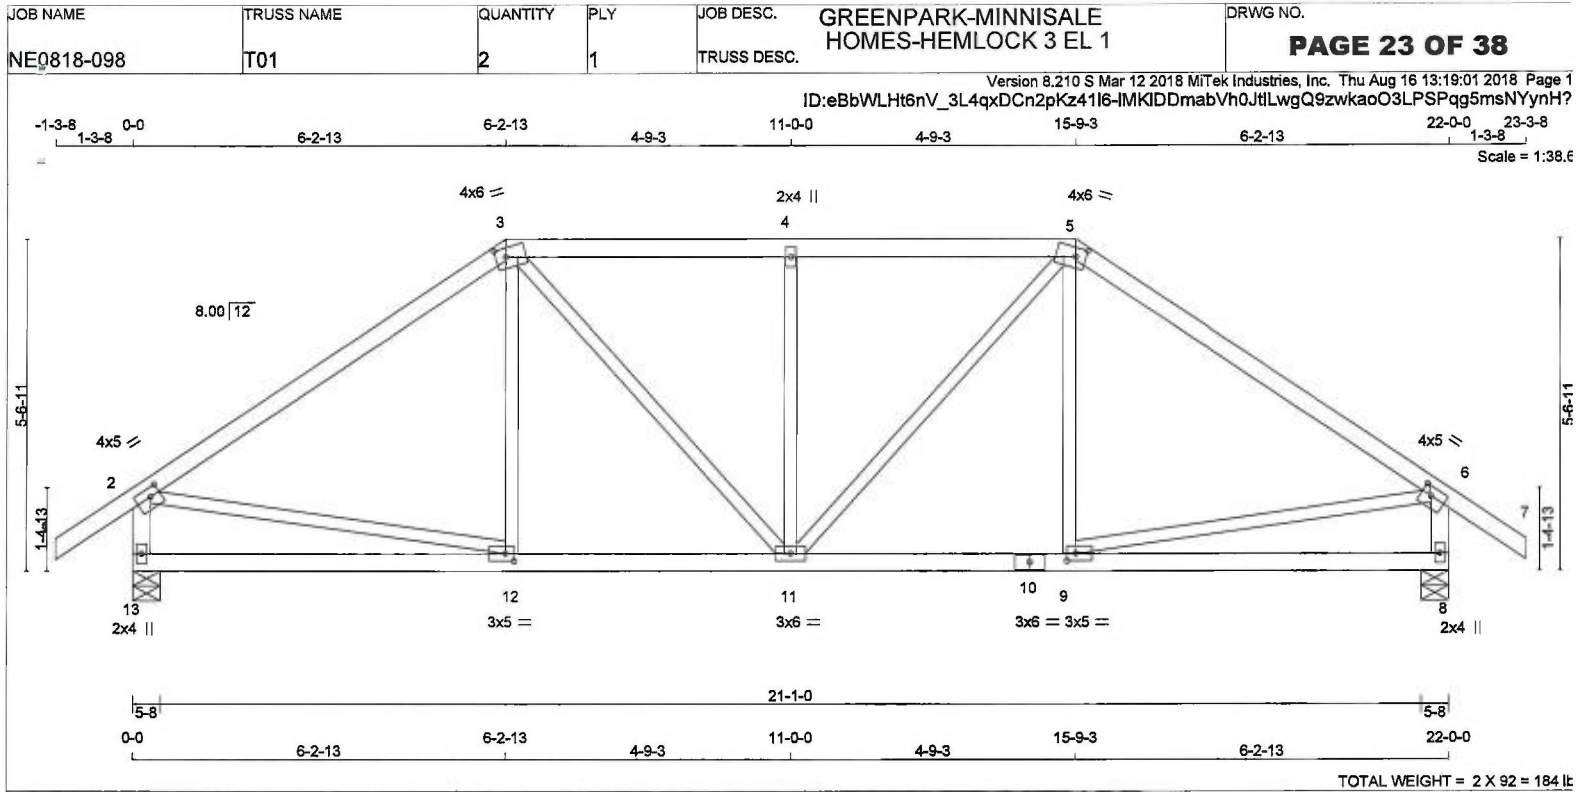

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
1 - 3	2x4	DRY	No.2
2 - 5	2x4	DRY	No.2
5 - 7	2x4	DRY	No.2
13 - 2	2x4	DRY	No.2
8 - 6	2x4	DRY	No.2
13 - 10	2x4	DRY	No.2
10 - 8	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMVW-t	MT20	4.0	5.0	1.75	2.00
3	TTWW-m	MT20	4.0	6.0	1.75	2.00
4	TMVW-w	MT20	2.0	4.0		
5	TTWW-m	MT20	4.0	6.0	1.75	2.00
6	TMVW-t	MT20	4.0	5.0	1.75	2.00
8	BMV1+p	MT20	2.0	4.0		
9	BMVW-t	MT20	3.0	5.0	1.50	1.75
10	BS-t	MT20	3.0	6.0		
11	BMVW-w	MT20	3.0	6.0		
12	BMVW-t	MT20	3.0	5.0	1.50	1.75
13	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG UPLIFT IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
13	1150	0	1150	0	5-8	5-8
8	1150	0	1150	0	5-8	5-8

UNFACTORED REACTIONS							
JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
13	804	576 / 0	0 / 0	0 / 0	0 / 0	228 / 0	0 / 0
8	804	576 / 0	0 / 0	0 / 0	0 / 0	228 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 13, 8

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.54 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC)	MEMB.
FR-TO		FROM	TO	FR-TO		FROM	TO
1-2	0 / 29	-77.4	-77.4	10.00	12-3	-35 / 85	0.03 (4)
2-3	-1085 / 0	-77.4	-77.4	0.42 (1)	5.54	3-11	0 / 342
3-4	-1131 / 0	-77.4	-77.4	0.23 (1)	5.71	11-4	-449 / 0
4-5	-1131 / 0	-77.4	-77.4	0.23 (1)	5.71	11-5	0 / 342
5-6	-1085 / 0	-77.4	-77.4	0.42 (1)	5.54	9-5	-35 / 85
6-7	0 / 29	-77.4	-77.4	0.10 (1)	10.00	2-12	0 / 915
13-2	-1104 / 0	0.0	0.0	0.11 (1)	7.54	9-6	0 / 915
8-6	-1104 / 0	0.0	0.0	0.11 (1)	7.54		
13-12	0 / 0	-17.5	-17.5	0.15 (4)	10.00		
12-11	0 / 901	-17.5	-17.5	0.23 (1)	10.00		
11-10	0 / 901	-17.5	-17.5	0.23 (1)	10.00		
10-9	0 / 901	-17.5	-17.5	0.23 (1)	10.00		
9-8	0 / 0	-17.5	-17.5	0.15 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.73")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL) = L/360 (0.73")
CALCULATED VERT. DEFL.(TL) = L/999 (0.06")

CSI: TC=0.42/1.00 (5-6:1), BC=0.23/1.00 (9-11:1), WB=0.21/1.00 (4-11:1), SSI=0.18/1.00 (4-5:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (12) (INPUT = 0.90)
JSI METAL= 0.38 (2) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



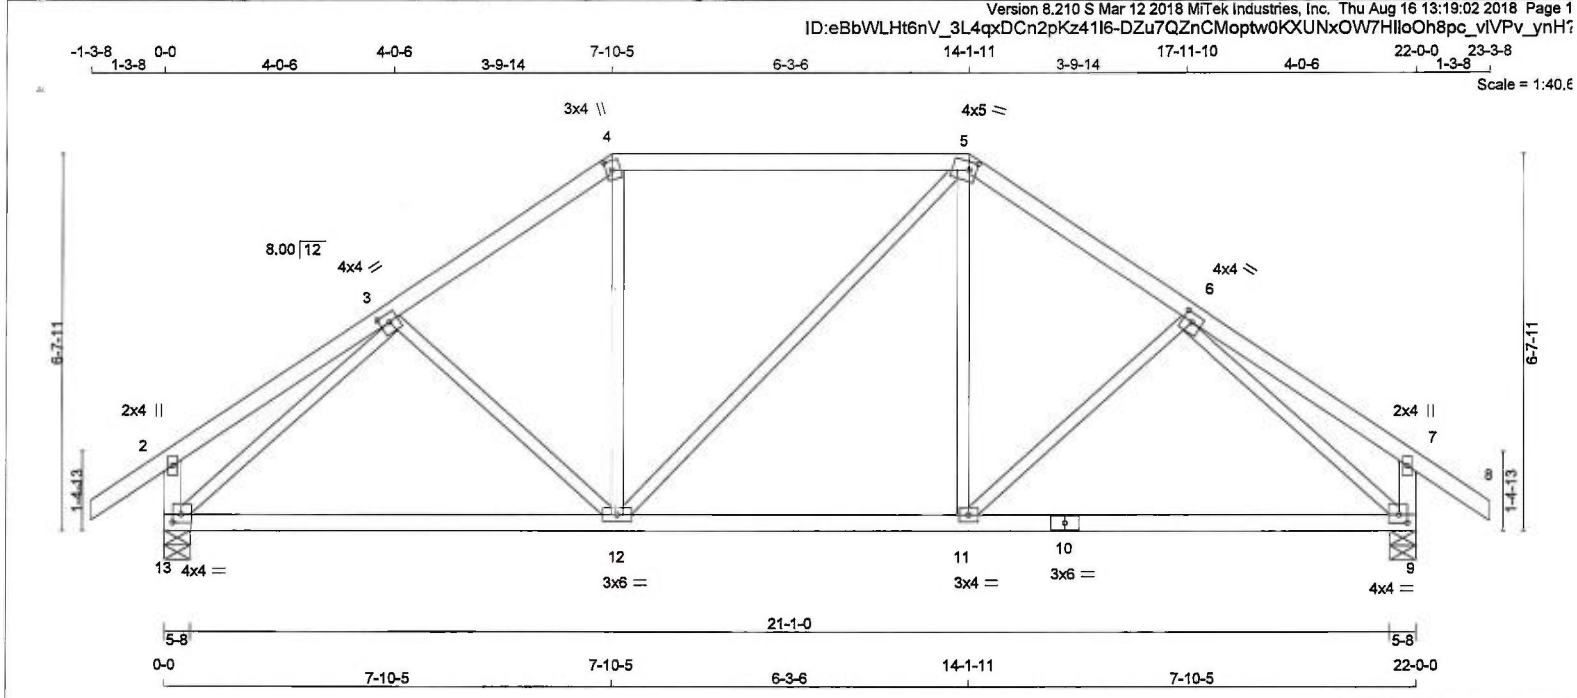


LUMBER										DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										DESIGN CRITERIA									
N. L. G. A. RULES										BEARINGS										SPECIFIED LOADS:									
CHORDS SIZE LUMBER DESCR.																				TOP CH. LL = 23.3 PSF									
1 - 4 2x4 DRY No.2 SPF										FACTORED GROSS REACTION										DL = 3.0 PSF									
4 - 5 2x4 DRY No.2 SPF										MAXIMUM FACTORED GROSS REACTION										BOT CH. LL = 0.0 PSF									
5 - 8 2x4 DRY No.2 SPF										INPUT BRG										DL = 7.0 PSF									
13- 2 2x4 DRY No.2 SPF										REQRD BRG										TOTAL LOAD = 33.3 PSF									
9 - 7 2x4 DRY No.2 SPF										JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX																			
13- 10 2x4 DRY No.2 SPF										13 1150 0 1150 0 0 5-8 5-8																			
10- 9 2x4 DRY No.2 SPF										9 1150 0 1150 0 0 5-8 5-8																			
ALL WEBS 2x3 DRY No.2 SPF										UNFACTORED REACTIONS										SPACING = 24.0 IN. C/C									
EXCEPT										1ST LCASE MAX./MIN. COMPONENT REACTIONS																			
DRY: SEASONED LUMBER.										JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL										LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM									
										13 804 576 / 0 0 / 0 0 / 0 0 / 0 228 / 0 0 / 0										THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010									
										9 804 576 / 0 0 / 0 0 / 0 0 / 0 228 / 0 0 / 0										THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012, BCBC 2012, ABC 2014 - CSA 086-09 - TPIC 2011									
										BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 13, 9										(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD									
										BRACING										ALLOWABLE DEFL.(LL)= L/360 (0.73")									
										TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.01 FT.										CALCULATED VERT. DEFL.(LL) = L/ 999 (0.03")									
										MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.										ALLOWABLE DEFL.(TL)= L/360 (0.73")									
										ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.										CALCULATED VERT. DEFL.(TL) = L/ 999 (0.13")									
										LOADING										CSI: TC=0.40/1.00 (4-5:1) , BC=0.29/1.00 (9-11:4) , WB=0.60/1.00 (3-13:1) , SSI=0.19/1.00 (4-5:1)									
										TOTAL LOAD CASES: (4)										DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10									
																				COMP=1.10 SHEAR=1.10 TENS= 1.10									
																				COMPANION LIVE LOAD FACTOR = 0.50									
																				TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .									
																				NAIL VALUES									
																				PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)									
																				MAX MIN MAX MIN MAX MIN									
																				MT20 618 354 1667 822 2284 1656									
																				PLATE PLACEMENT TOL. = 0.250 inches									
																				PLATE ROTATION TOL. = 5.0 Deg.									
																				JSI GRIP= 0.88 (3) (INPUT = 0.90)									
																				JSI METAL= 0.46 (3) (INPUT = 1.00)									

Aug 16, 2018

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



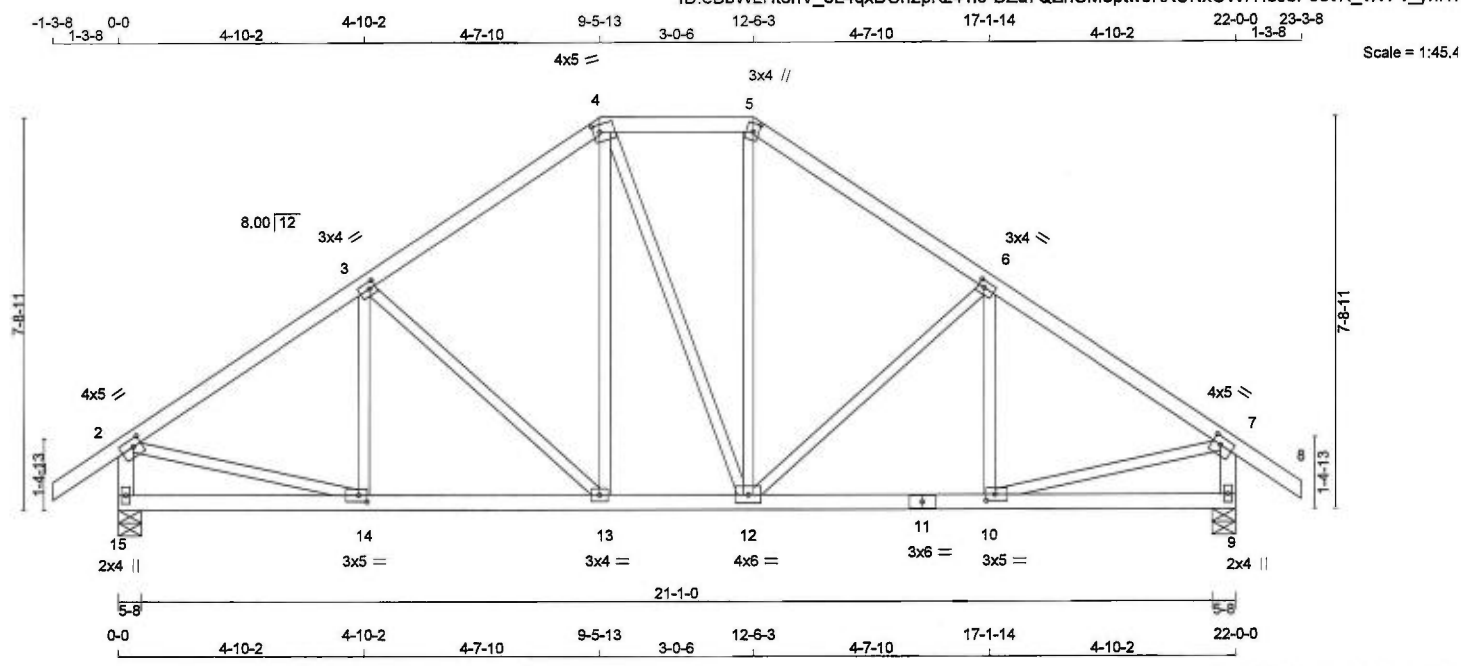

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR.
1 - 4	2x4	DRY	No.2	SPF
4 - 5	2x4	DRY	No.2	SPF
5 - 8	2x4	DRY	No.2	SPF
15 - 2	2x4	DRY	No.2	SPF
9 - 7	2x4	DRY	No.2	SPF
15 - 11	2x4	DRY	No.2	SPF
11 - 9	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
2	TMVW-t	MT20	4.0	5.0	1.75 2.00
3	TMWW-t	MT20	3.0	4.0	1.50 1.50
4	TTWW-m	MT20	4.0	5.0	1.75 1.50
5	TTW+m	MT20	3.0	4.0	2.00 1.25
6	TMWW-t	MT20	3.0	4.0	1.50 1.50
7	TMVW-t	MT20	4.0	5.0	1.75 2.00
9	BMV1+p	MT20	2.0	4.0	
10	BMWW-t	MT20	3.0	5.0	1.50 2.00
11	BS-t	MT20	3.0	6.0	
12	BMWWWW-t	MT20	4.0	6.0	
13	BMWW-t	MT20	3.0	4.0	
14	BMWW-t	MT20	3.0	5.0	1.50 2.00
15	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
		GROSS REACTION		GROSS REACTION		BRG		IN-SX	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
15		1150	0	1150	0	0	5-8	5-8	
9		1150	0	1150	0	0	5-8	5-8	

UNFACTORED REACTIONS							
		MAX./MIN. COMPONENT REACTIONS					
JT	1ST LCASE COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
15	804	576 / 0	0 / 0	0 / 0	0 / 0	228 / 0	0 / 0
9	804	576 / 0	0 / 0	0 / 0	0 / 0	228 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 15, 9

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.68 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
		MAX. FACTORED		FACTORED		MAX. FACTORED		FACTORED	
MEMB.	FORCE (LBS)	VERT.	LOAD (PLF)	MAX. (LC)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX. (LC)	
FR-TO									
1-2	0 / 29	-77.4	-77.4	0.10 (1)	10.00	14-3	-122 / 46	0.04 (1)	
2-3	-1143 / 0	-77.4	-77.4	0.24 (1)	5.68	3-13	-287 / 0	0.21 (1)	
3-4	-937 / 0	-77.4	-77.4	0.23 (1)	6.12	13-4	0 / 253	0.06 (1)	
4-5	-763 / 0	-77.4	-77.4	0.10 (1)	6.25	4-12	0 / 3	0.00 (1)	
5-6	-938 / 0	-77.4	-77.4	0.23 (1)	6.12	12-5	0 / 256	0.06 (1)	
6-7	-1142 / 0	-77.4	-77.4	0.24 (1)	5.68	12-6	-286 / 0	0.21 (1)	
7-8	0 / 29	-77.4	-77.4	0.10 (1)	10.00	10-6	-124 / 45	0.04 (1)	
15-2	-1114 / 0	0.0	0.0	0.11 (1)	7.51	2-14	0 / 994	0.22 (1)	
9-7	-1114 / 0	0.0	0.0	0.11 (1)	7.51	10-7	0 / 994	0.22 (1)	
15-14	0 / 0	-17.5	-17.5	0.10 (4)	10.00				
14-13	0 / 971	-17.5	-17.5	0.20 (1)	10.00				
13-12	0 / 762	-17.5	-17.5	0.15 (1)	10.00				
12-11	0 / 970	-17.5	-17.5	0.20 (1)	10.00				
11-10	0 / 970	-17.5	-17.5	0.20 (1)	10.00				
10-9	0 / 0	-17.5	-17.5	0.10 (4)	10.00				

DESIGN CRITERIA				
SPECIFIED LOADS:				
TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.0	PSF
TOTAL LOAD	=	33.3	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.73")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.03")
ALLOWABLE DEFL.(TL)= L/360 (0.73")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.06")

CSI: TC=0.24/1.00 (2-3:1), BC=0.20/1.00 (13-14:1)
WB=0.22/1.00 (2-14:1), SSI=0.15/1.00 (2-3:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (5) (INPUT = 0.90)
JSI METAL= 0.39 (2) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



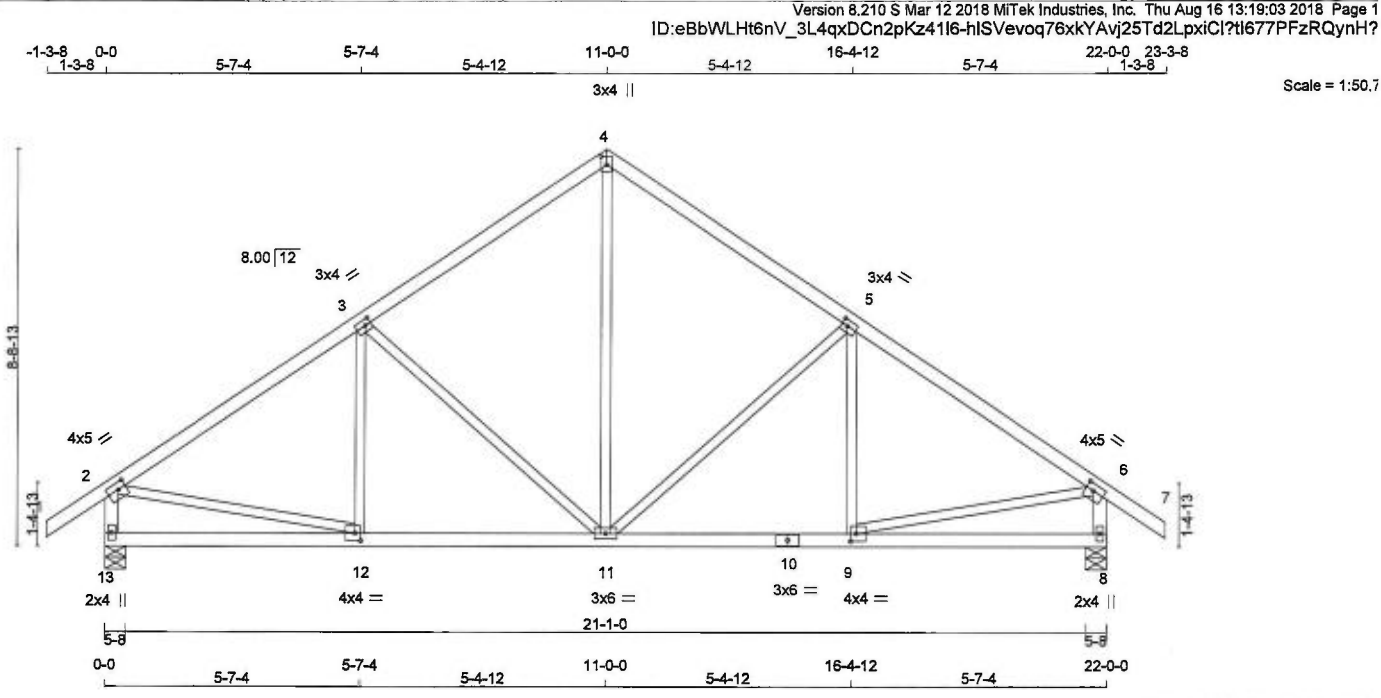

LUMBER						DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										DESIGN CRITERIA																		
N. L. G. A. RULES																																		
CHORDS		SIZE		LUMBER		DESCR.																												
1 - 4		2x4		DRY		No.2		SPF																										
4 - 7		2x4		DRY		No.2		SPF																										
13- 2		2x4		DRY		No.2		SPF																										
8 - 6		2x4		DRY		No.2		SPF																										
13- 10		2x4		DRY		No.2		SPF																										
10- 8		2x4		DRY		No.2		SPF																										
ALL WEBS EXCEPT						2x3		DRY		No.2		SPF																						
														BEARINGS																				
														FACTORED GROSS REACTION					MAXIMUM FACTORED GROSS REACTION					INPUT BRG					REQRD BRG					
														JT		VERT		HORZ		DOWN		HORZ		UPLIFT		IN-SX		IN-SX						
														13		1150		0		1150		0		0		5-8		5-8						
														8		1150		0		1150		0		0		5-8		5-8						
														UNFACTORED REACTIONS																				
														1ST LCASE MAX./MIN. COMPONENT REACTIONS																				
														IT		COMBRGR		SNOW		LIVE		DEBR/LIVE		WIND		DEAD		SOIL						

DRY: SEASONED LUMBER.

TOTAL WEIGHT = 4 X 95 = 381 lb

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
2	TMVW-t	MT20	4.0	5.0	1.75 2.00
3	TMWW-t	MT20	3.0	4.0	1.50 1.50
4	TTW+p	MT20	3.0	4.0	2.25 1.50
5	TMVW-t	MT20	3.0	4.0	1.50 1.50
6	TMVW-t	MT20	4.0	5.0	1.75 2.00
8	BMV1+p	MT20	2.0	4.0	
9	BMWW-t	MT20	4.0	4.0	2.00 1.50
10	BS-t	MT20	3.0	6.0	
11	BMWWW-t	MT20	3.0	6.0	
12	BMWW-t	MT20	4.0	4.0	2.00 1.50
13	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED			MAXIMUM FACTORED			INPUT		REQRD	
GROSS REACTION			GROSS REACTION			BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX		IN-SX	
13	1150	0	1150	0	0	5-8		5-8	
8	1150	0	1150	0	0	5-8		5-8	

UNFACTORED REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
13	804	576 / 0	0 / 0	0 / 0	0 / 0	228 / 0	0 / 0
8	804	576 / 0	0 / 0	0 / 0	0 / 0	228 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 13, 8

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.57 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)
FR-TO		FROM TO		FR-TO		FROM TO	
1-2	0 / 29	-77.4 -77.4	0.10 (1)	10.00	11-4	0 / 602	0.14 (1)
2-3	-1141 / 0	-77.4 -77.4	0.33 (1)	5.57	11-5	-384 / 0	0.39 (1)
3-4	-854 / 0	-77.4 -77.4	0.31 (1)	6.22	9-5	-82 / 67	0.03 (1)
4-5	-854 / 0	-77.4 -77.4	0.31 (1)	6.22	3-11	-384 / 0	0.39 (1)
5-6	-1141 / 0	-77.4 -77.4	0.33 (1)	5.57	12-3	-82 / 67	0.03 (1)
6-7	0 / 29	-77.4 -77.4	0.10 (1)	10.00	2-12	0 / 991	0.22 (1)
13-2	-1109 / 0	0.0 0.0	0.11 (1)	7.52	9-6	0 / 991	0.22 (1)
8-6	-1109 / 0	0.0 0.0	0.11 (1)	7.52			
13-12	0 / 0	-17.5 -17.5	0.13 (4)	10.00			
12-11	0 / 973	-17.5 -17.5	0.22 (1)	10.00			
11-10	0 / 973	-17.5 -17.5	0.22 (1)	10.00			
10-9	0 / 973	-17.5 -17.5	0.22 (1)	10.00			
9-8	0 / 0	-17.5 -17.5	0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.73")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL)= L/360 (0.73")
CALCULATED VERT. DEFL.(TL) = L/999 (0.06")

CSI: TC=0.33/1.00 (5-6:1), BC=0.22/1.00 (9-11:1), WB=0.39/1.00 (5-11:1), SSI=0.17/1.00 (5-6:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (1) (INPUT = 0.90)
JSI METAL= 0.40 (2) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



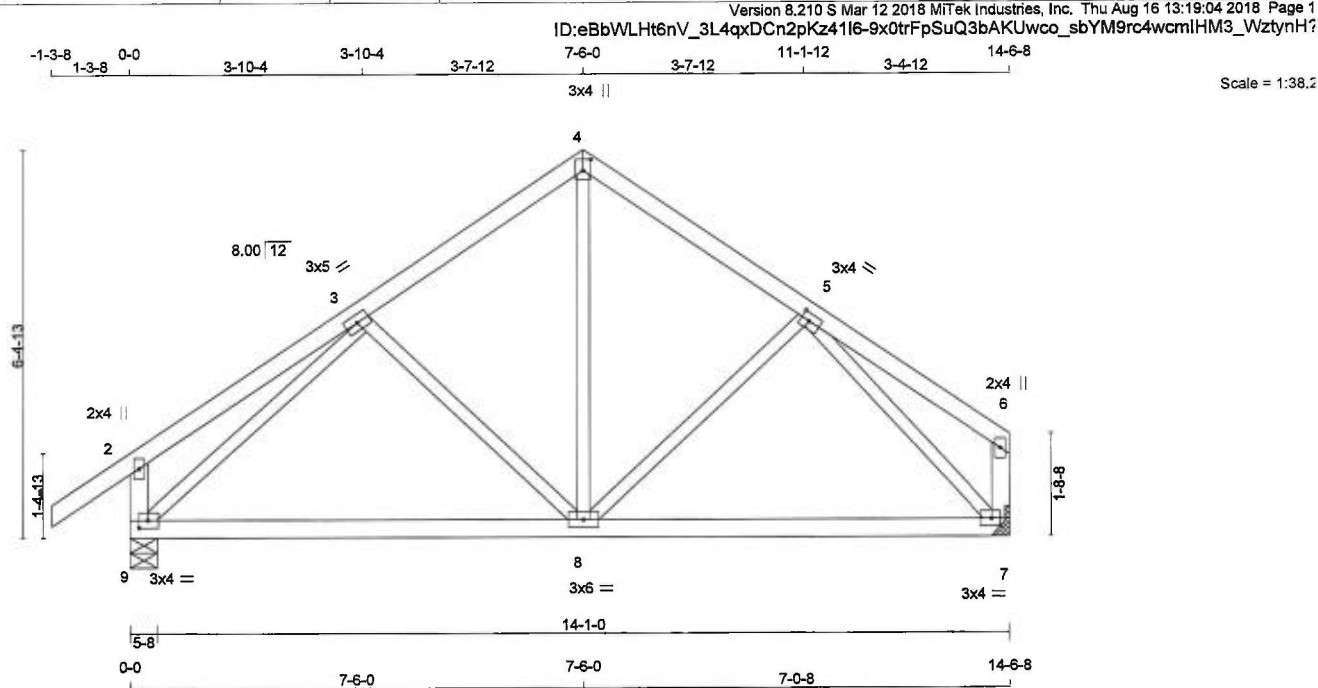

TOTAL WEIGHT = 3 X 61 = 184 lb [M]F

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
1 - 4	2x4	DRY	No.2
4 - 6	2x4	DRY	No.2
9 - 2	2x4	DRY	No.2
7 - 6	2x4	DRY	No.2
9 - 7	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMV+p	MT20	2.0	4.0		
3	TMVW-t	MT20	3.0	5.0		
4	TTW+p	MT20	3.0	4.0	2.25	1.50
5	TMVW-t	MT20	3.0	4.0	1.50	1.75
6	TMV+p	MT20	2.0	4.0		
7	BMVW1-t	MT20	3.0	4.0	1.50	1.75
8	BMVW1-t	MT20	3.0	6.0		
9	BMVW1-t	MT20	3.0	4.0	1.50	1.75

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
9	796	0	796	0
7	690	0	690	0

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT 7 TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX/MIN. COMPONENT REACTIONS	DEAD	SOIL
9	556	403 / 0	0 / 0	0 / 0
7	484	339 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 9

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD LC1 (LC)	MAX. FACTORED VERT. LOAD LC1 (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
1-2	0 / 29	-77.4	-77.4 0.10 (1)	10.00	3-8	-168 / 3	0.08 (1)
2-3	0 / 18	-77.4	-77.4 0.17 (1)	10.00	8-4	0 / 345	0.08 (1)
3-4	-535 / 0	-77.4	-77.4 0.13 (1)	6.25	8-5	-104 / 17	0.05 (1)
4-5	-533 / 0	-77.4	-77.4 0.12 (1)	6.25	9-3	-763 / 0	0.33 (1)
5-6	0 / 19	-77.4	-77.4 0.15 (1)	10.00	5-7	-747 / 0	0.28 (1)
9-2	-218 / 0	0.0	0.0 0.02 (1)	7.81			
7-6	-94 / 0	0.0	0.0 0.01 (1)	7.81			
9-8	0 / 552	-17.5	-17.5 0.30 (4)	10.00			
8-7	0 / 505	-17.5	-17.5 0.30 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 23.3	PSF
	DL	= 3.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.0	PSF
TOTAL LOAD		= 33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.48")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.48")
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CSI: TC=0.17/1.00 (2-3:1), BC=0.30/1.00 (8-9:4),
WB=0.33/1.00 (3-9:1), SSI=0.12/1.00 (3-4:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (9) (INPUT = 0.90)
JSI METAL= 0.26 (5) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



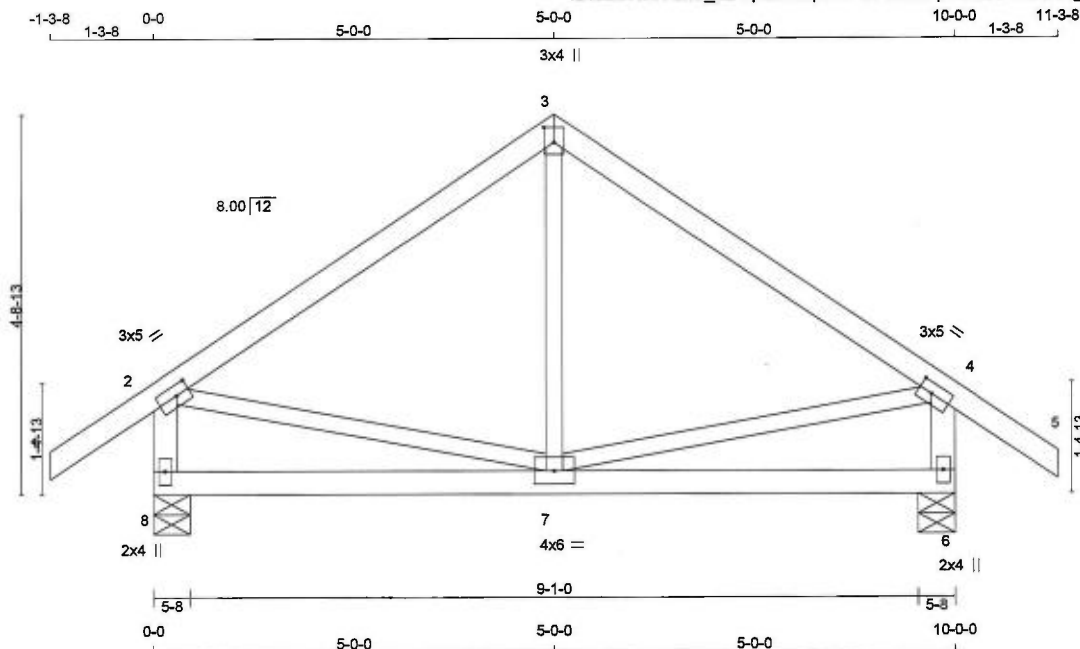

TOTAL WEIGHT = 42 lb
 [M]F

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
1 - 3	2x4	DRY	No.2	SPF	
3 - 5	2x4	DRY	No.2	SPF	
8 - 2	2x4	DRY	No.2	SPF	
6 - 4	2x4	DRY	No.2	SPF	
8 - 6	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
1	TMVW-t	MT20	3.0	5.0	1.50	2.00	
2	TTW+p	MT20	3.0	4.0	2.25	1.50	
3	TMVW-t	MT20	3.0	5.0	1.50	2.00	
4	BMV1+p	MT20	2.0	4.0			
5	BMVWW-t	MT20	4.0	6.0			
6	BMV1+p	MT20	2.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BRIDGING DESIGNER							
BEARINGS							
	FACTORED		MAXIMUM FACTORED			INPUT	REQRD
	GROSS REACTION		GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
8	580	0	580	0	0	5-8	5-8
6	580	0	580	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX./MIN. COMPONENT REACTIONS	JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
8	405	297 / 0	0 / 0	0 / 0	0 / 0	108 / 0	0 / 0	0 / 0	0 / 0
6	405	297 / 0	0 / 0	0 / 0	0 / 0	108 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 8, 6

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. (LC)
FR-TO			FROM	TO		FR-TO			
1-2	0 / 29	-77.4	-77.4	0.10 (1)	10.00	7-3	-13 / 82	0.03 (4)	
2-3	-336 / 0	-77.4	-77.4	0.25 (1)	6.25	2-7	0 / 286	0.06 (1)	
3-4	-336 / 0	-77.4	-77.4	0.25 (1)	6.25	7-4	0 / 286	0.06 (1)	
4-5	0 / 29	-77.4	-77.4	0.10 (1)	10.00				
8-2	-547 / 0	0.0	0.0	0.06 (1)	7.81				
6-4	-547 / 0	0.0	0.0	0.06 (1)	7.81				
8-7	0 / 0	-17.5	-17.5	0.12 (4)	10.00				
7-6	0 / 0	-17.5	-17.5	0.12 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 23.3 PSF
 DL = 3.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.0 PSF
 TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
 - PART 9 OF OBC 2012, CBC 2012, ABC 2014
 - CSA 086-09
 - TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.33")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
 ALLOWABLE DEFL.(TL)= L/360 (0.33")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.25/1.00 (3-4:1), BC=0.12/1.00 (7-8:4),
 WB=0.06/1.00 (2-7:1), SSI=0.13/1.00 (3-4:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.50 (4) (INPUT = 0.90)
 JSI METAL= 0.15 (2) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



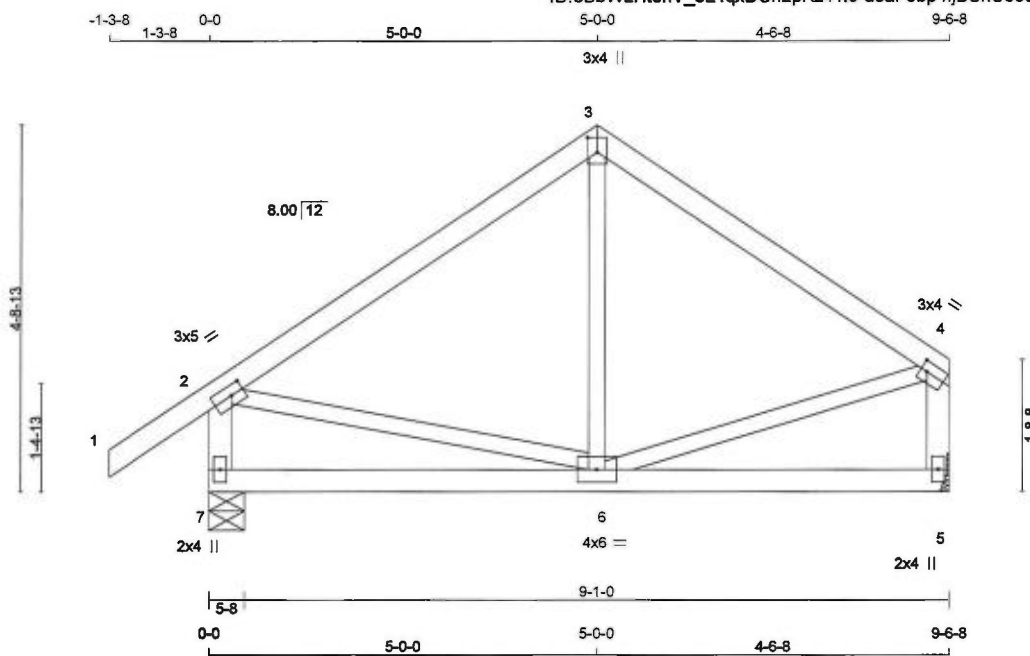

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER
1 - 3	2x4	DRY No.2
3 - 4	2x4	DRY No.2
7 - 2	2x4	DRY No.2
5 - 4	2x4	DRY No.2
7 - 5	2x4	DRY No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMVW-t	MT20	3.0	5.0	1.50	2.00
3	TTW+p	MT20	3.0	4.0	2.25	1.50
4	TMVW-t	MT20	3.0	4.0	1.50	1.00
5	BMV1+p	MT20	2.0	4.0		
6	BMVWW-t	MT20	4.0	6.0		
7	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT VERT HORZ	DOWN HORZ UPLIFT	IN-SX	IN-SX
7 559 0	559 0 0	5-8	5-8
5 453 0	453 0 0	MECHANICAL	

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT 5 TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

1ST LCASE	MAX./MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
7 390	286 / 0 0 / 0 0 / 0 104 / 0 0 / 0
5 318	222 / 0 0 / 0 0 / 0 95 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 7

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
1-2	0 / 29	-77.4 -77.4	0.10 (1)	10.00	6-3	-30 / 72	0.03 (4)
2-3	-306 / 0	-77.4 -77.4	0.25 (1)	6.25	2-6	0 / 260	0.06 (1)
3-4	-304 / 0	-77.4 -77.4	0.20 (1)	6.25	6-4	0 / 266	0.06 (1)
7-2	-522 / 0	0.0 0.0	0.05 (1)	7.81			
5-4	-425 / 0	0.0 0.0	0.05 (1)	7.81			
7-6	0 / 0	-17.5 -17.5	0.12 (4)	10.00			
6-5	0 / 0	-17.5 -17.5	0.12 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.32")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.32")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.25/1.00 (2-3:1), BC=0.12/1.00 (6-7:4), WB=0.06/1.00 (4-6:1), SSI=0.13/1.00 (2-3:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (4) (INPUT = 0.90)
JSI METAL= 0.15 (4) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



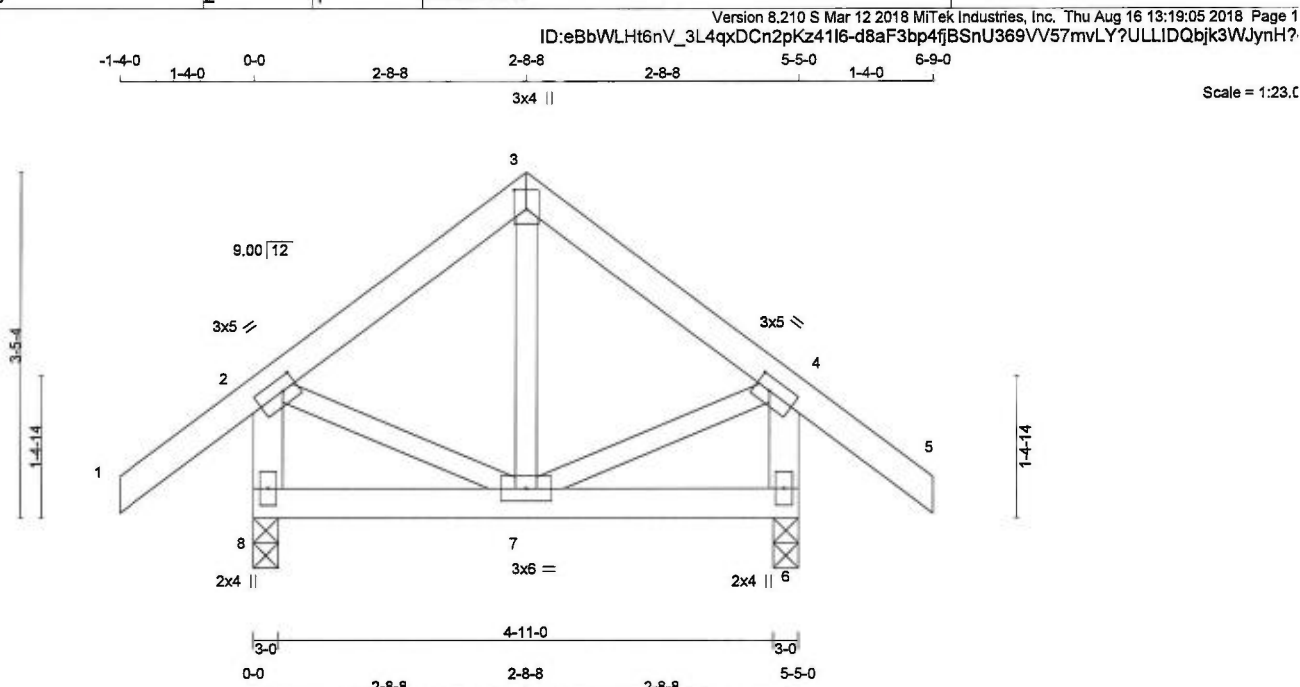

TOTAL WEIGHT = 2 X 27 = 54 lb [M]

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR.

1 - 3	2x4	DRY	No.2	SPF
3 - 5	2x4	DRY	No.2	SPF
8 - 2	2x4	DRY	No.2	SPF
6 - 4	2x4	DRY	No.2	SPF
8 - 6	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQRD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
8	367	0	367	0	3-0	3-0
6	367	0	367	0	3-0	3-0

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED		MAX./MIN. LIVE		PERM. LIVE	WIND	DEAD	SOIL
	SNOW	LIVE	SNOW	LIVE				
8	255	192 / 0	0 / 0	0 / 0	0 / 0	0 / 0	63 / 0	0 / 0
6	255	192 / 0	0 / 0	0 / 0	0 / 0	0 / 0	63 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 8, 6

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)		
FR-TO		FROM TO			FR-TO				
1-2	0 / 33	-77.4	-77.4 0.11 (1)	10.00	7-3	-36 / 35	0.01 (4)		
2-3	-145 / 0	-77.4	-77.4 0.10 (1)	6.25	2-7	0 / 125	0.03 (1)		
3-4	-145 / 0	-77.4	-77.4 0.10 (1)	6.25	7-4	0 / 125	0.03 (1)		
4-5	0 / 33	-77.4	-77.4 0.11 (1)	10.00					
8-2	-348 / 0	0.0	0.0 0.04 (1)	7.81					
6-4	-348 / 0	0.0	0.0 0.04 (1)	7.81					
8-7	0 / 0	-17.5	-17.5 0.03 (4)	10.00					
7-6	0 / 0	-17.5	-17.5 0.03 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.11/1.00 (1-2:1), BC=0.03/1.00 (7-8:4), VB=0.03/1.00 (2-7:1), SSI=0.07/1.00 (1-2:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.29 (4) (INPUT = 0.90)
JSI METAL= 0.08 (4) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



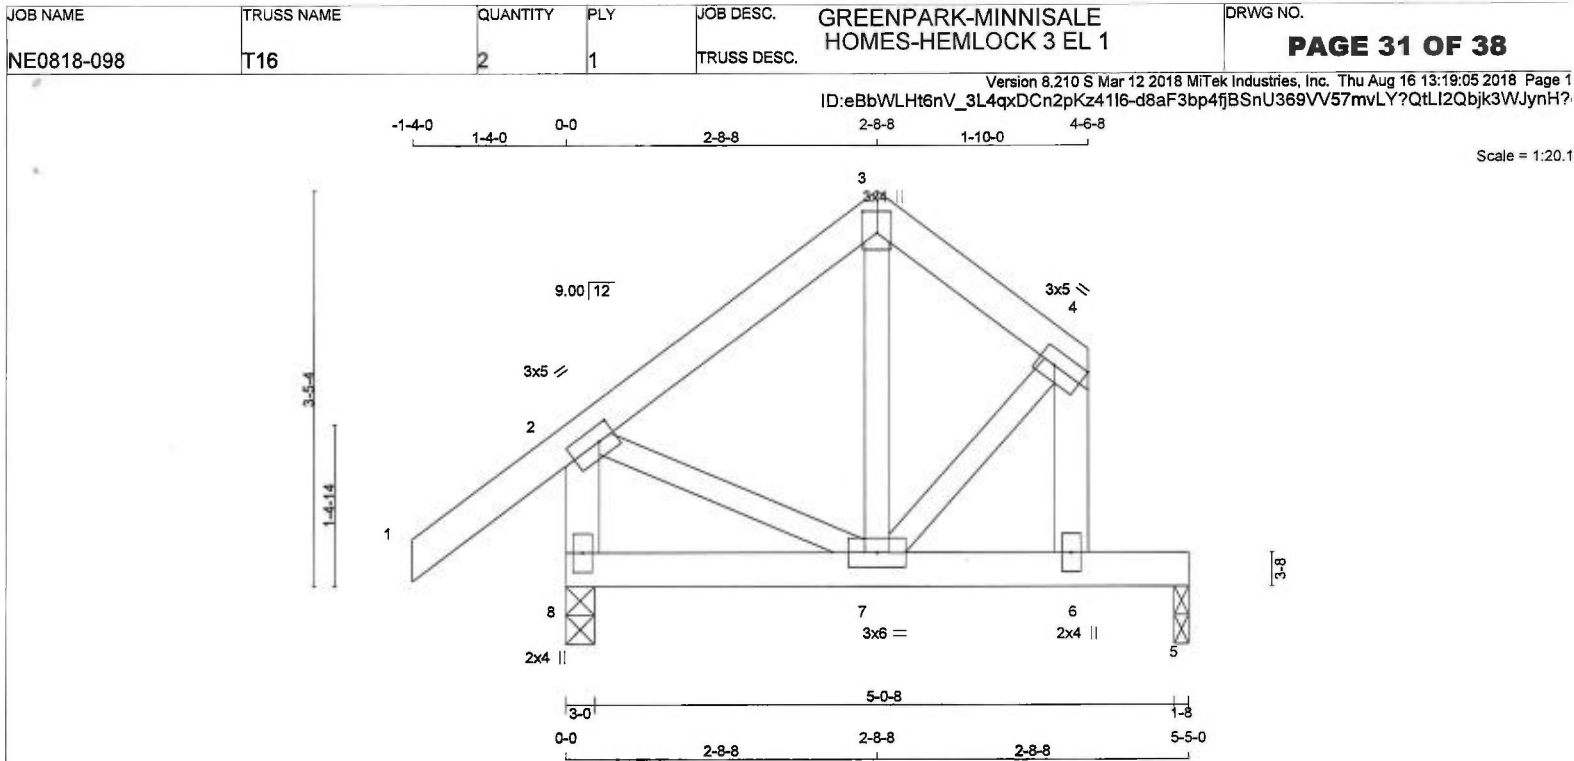

LUMBER

N. L. G. A. RULES

CHORDS

SIZE

DRY

LUMBER

DESCR.

1 - 3

2x4

DRY

No.2

SPF

3 - 4

2x4

DRY

No.2

SPF

8 - 2

2x4

DRY

No.2

SPF

6 - 4

2x4

DRY

No.2

SPF

8 - 5

2x4

DRY

No.2

SPF

ALL WEBS EXCEPT

2x3

DRY

No.2

SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT

TYPE

PLATES

W

LEN

Y

X

2

TMVVW-t

MT20

3.0

5.0

1.50

1.75

3

TTW+p

MT20

3.0

4.0

2.25

1.50

4

TMVVW-t

MT20

3.0

5.0

1.50

Edge

6

BMV+p

MT20

2.0

4.0

7

BMWWW-t

MT20

3.0

6.0

8

BMV1+p

MT20

2.0

4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION

MAXIMUM FACTORED GROSS REACTION

INPUT BRG

REQRD BRG

JT

VERT

HORZ

DOWN

HORZ

UPLIFT

IN-SX

IN-SX

8

367

0

367

0

0

3-0

3-0

5

257

0

257

0

0

1-8

1-8

UNFACTORED REACTIONS

1ST LCASE

MAX./MIN. COMPONENT REACTIONS

JT

COMBINED

SNOW

LIVE

PERM.LIVE

WIND

DEAD

SOIL

8

255

192 / 0

0 / 0

0 / 0

0 / 0

63 / 0

0 / 0

5

180

126 / 0

0 / 0

0 / 0

0 / 0

54 / 0

0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 8, 5

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS

MEMB.

MAX. FACTORED FORCE (LBS)

FACTORED VERT. LOAD (PLF)

MAX. VERT. LOAD (LC)

MAX. UNBRACED LENGTH

WEBS

MEMB.

MAX. FACTORED FORCE (LBS)

MAX. VERT. LOAD (LC)

FR-TO

FROM

TO

FR-TO

FROM

TO

1-2

0 / 33

-77.4

-77.4

0.11 (1)

10.00

7-3

0 / 42

0.01 (4)

2-3

-158 / 0

-77.4

-77.4

0.10 (1)

6.25

2-7

0 / 136

0.03 (1)

3-4

-158 / 0

-77.4

-77.4

0.04 (1)

6.25

7-4

0 / 174

0.04 (1)

8-2

-360 / 0

0.0

0.0

0.04 (1)

7.81

6-4

-285 / 0

0.0

0.0

0.03 (1)

7.81

8-7

0 / 0

-17.5

-17.5

0.06 (1)

10.00

7-6

0 / 0

-17.5

-17.5

0.26 (1)

10.00

6-5

0 / 0

-94.9

-94.9

0.26 (1)

10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 23.3 PSF

DL = 3.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.0 PSF

TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014

- CSA 086-09

- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")

CALCULATED VERT. DEFL.(LL) = L/999 (0.02")

ALLOWABLE DEFL.(TL)= L/360 (0.19")

CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.11/1.00 (1-2:1), BC=0.26/1.00 (6-7:1), WB=0.04/1.00 (4-7:1), SSI=0.20/1.00 (5-6:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.39 (4) (INPUT = 0.90)

JSI METAL= 0.09 (2) (INPUT = 1.00)

REGISTERED PROFESSIONAL ENGINEER

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

Aug 16, 2018





TOTAL WEIGHT = $2 \times 9 = 17$ lb

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING BEARINGS

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS
CHORD AT JT(S): 3

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) 4

PROVIDE ANCHORAGE AT BEARING JOINT 3 FOR 150 LBS FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT 4 FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 5. 3. 4

BRACING


TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

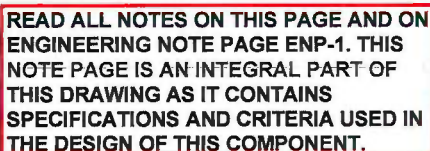

DESIGN CRITERIA

SPECIFIED LOADS-

TOP	CH.	LL =	23.3	PSF
		DL =	3.0	PSF
BOT	CH.	LL =	0.0	PSF
		DL =	7.0	PSF
TOTAL LOAD		=	33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , CBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.00")

CSI: TC=0.11/1.00 (1-2:1), BC=0.03/1.00 (4-5:5),
WB=0.00/1.00 (n/a:0), SSI=0.06/1.00 (1-2:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES


PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (2) (INPUT = 0.90)
JSI METAL= 0.06 (2) (INPUT = 1.00)



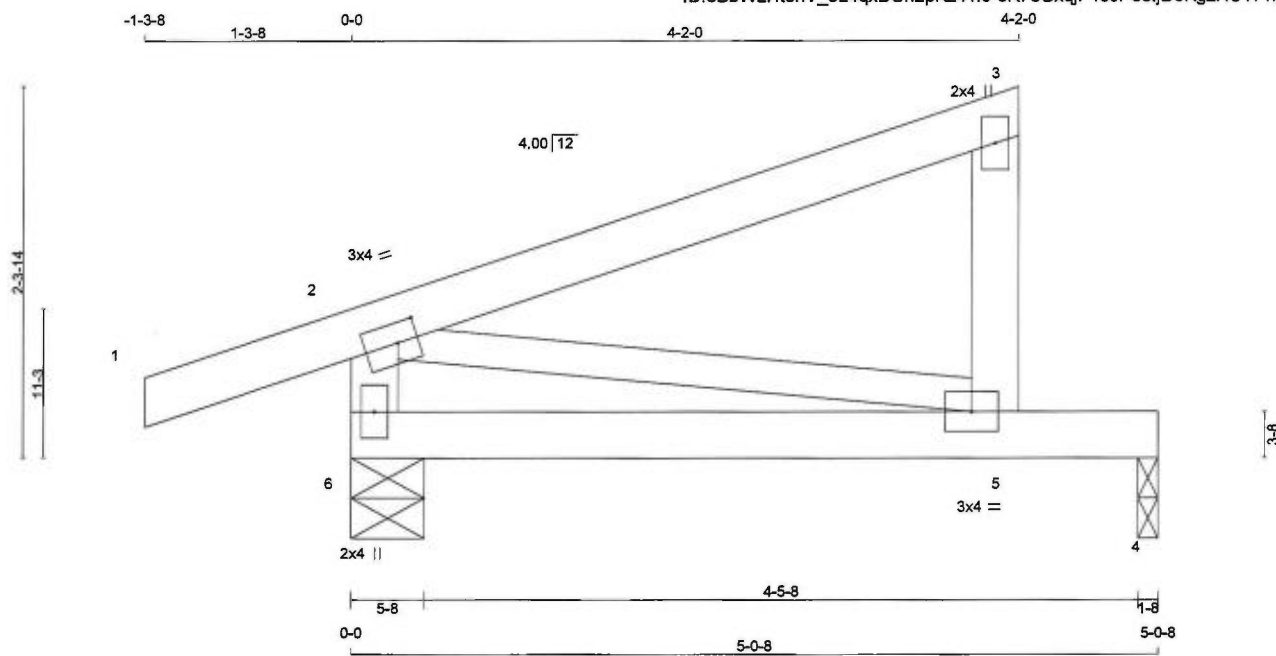

LUMBER				LUMBER			
N. L. G. A. RULES							
CHORDS	SIZE			DESCR.			
1 - 3	2x4	DRY	No.2	SPF			
5 - 3	2x4	DRY	No.2	SPF			
6 - 2	2x4	DRY	No.2	SPF			
6 - 4	2x4	DRY	No.2	SPF			
ALL WEBS 2x3 DRY No.2				SPF			
DRY: SEASONED LUMBER.							

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	X
2	TMVW-t	MT20	3.0	4.0	1.50
3	TMV+p	MT20	2.0	4.0	
5	BMVW-t	MT20	3.0	4.0	
6	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
6		337	0	337	0	0	5-8	5-8	
4		177	0	177	0	0	1-8	1-8	

UNFACTORED REACTIONS		MAX./MIN. COMPONENT REACTIONS						
JT	1ST LCASE	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
6		234	176 / 0	0 / 0	0 / 0	0 / 0	58 / 0	0 / 0
4		126	80 / 0	0 / 0	0 / 0	0 / 0	46 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 6, 4

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)									
		CHORDS					WEBS				
		MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 CSI (LC)		
		FR-TO		FROM	TO		FR-TO				
		1-2	0 / 16	-77.4	-77.4	0.10 (1)	10.00	2-5	0 / 0	0.00 (1)	
		2-3	0 / 0	-77.4	-77.4	0.23 (1)	10.00				
		5-3	-161 / 0	0.0	0.0	0.02 (1)	7.81				
		6-2	-265 / 0	0.0	0.0	0.03 (1)	7.81				
		6-5	0 / 0	-17.5	-17.5	0.20 (1)	10.00				
		5-4	0 / 0	-17.5	-17.5	0.20 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.03")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/ 835 (0.07")

CSI: TC=0.23/1.00 (2-3:1), BC=0.20/1.00 (5-6:1), WB=0.00/1.00 (2-5:1), SSI=0.14/1.00 (4-5:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
	MAX	MIN	MAX	MIN	MAX
MT20	618	354	1667	622	2284

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.24 (2) (INPUT = 0.90)
JSI METAL= 0.05 (6) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



DESCR.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

UNFACTORED REACTIONS

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 25. 14. 21

BRACING

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 - 1x4 LATERAL BRACE(S) AT 1/2 LENGTH OF 5-21, 6-21. DBS = 20-0-0. CBF = 145 LBS.

DBS = DIAGONAL BRACE SPACING (MAX). CBF = CUMULATIVE BRACING FORCE (PER BRACE). FASTEN LATERAL BRACE(S) USING (0.122"x3") SPIRAL NAILS: 1 NAIL FOR 2x3 BRACE(S). 2 FOR 1x4, 2x4, 2x5. 3 FOR 2x6. 4 FOR 2x8. 5 FOR 2x10. AND 6 FOR 2x12.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)		
FR-TO		FROM TO		LENGTH	FR-TO				
1-2	0 / 16	-77.4	-77.4	0.10 (1)	10.00	24-3	0 / 122	0.04 (4)	
2-3	-584 / 0	-77.4	-77.4	0.38 (1)	6.25	3-23	-849 / 0	0.75 (1)	
3-4	0 / 219	-77.4	-77.4	0.45 (1)	10.00	23-5	0 / 456	0.10 (1)	
4-5	0 / 219	-77.4	-77.4	0.45 (1)	10.00	5-21	-1159 / 0	0.55 (1)	
5-6	0 / 1196	-77.4	-77.4	0.61 (1)	10.00	6-21	-1149 / 0	0.38 (1)	
6-7	0 / 1295	-77.4	-77.4	0.50 (1)	10.00	21-7	-1068 / 0	0.97 (1)	
7-8	0 / 574	-77.4	-77.4	0.38 (1)	10.00	19-7	0 / 597	0.13 (1)	
8-9	0 / 574	-77.4	-77.4	0.38 (1)	10.00	9-9	-929 / 0	0.63 (1)	
9-10	-228 / 0	-77.4	-77.4	0.18 (1)	6.25	18-9	0 / 382	0.08 (1)	
10-11	-1154 / 0	-77.4	-77.4	0.13 (1)	5.80	18-10	-949 / 0	0.48 (1)	
11-12	-871 / 0	-77.4	-77.4	0.10 (1)	6.25	17-15	0 / 813	0.18 (1)	
12-13	0 / 16	-77.4	-77.4	0.10 (1)	10.00	17-11	0 / 327	0.07 (1)	
25-2	-551 / 0	0.0	0.0	0.06 (1)	7.81	15-11	-389 / 0	0.06 (1)	
14-12	-648 / 0	0.0	0.0	0.06 (1)	7.81	2-24	0 / 571	0.13 (1)	
						15-12	0 / 845	0.19 (1)	
25-24	0 / 0	-17.5	-17.5	0.16 (4)	10.00				
24-23	0 / 568	-17.5	-17.5	0.20 (4)	10.00				
23-22	-207 / 0	-17.5	-17.5	0.11 (4)	6.25				
22-21	-207 / 0	-17.5	-17.5	0.11 (4)	6.25				
21-20	-542 / 0	-17.5	-17.5	0.11 (4)	6.25				
20-19	-542 / 0	-17.5	-17.5	0.11 (4)	6.25				
19-18	0 / 220	-17.5	-17.5	0.14 (4)	10.00				
18-17	0 / 1116	-17.5	-17.5	0.25 (1)	10.00				
16-17	0 / 22	0.0	0.0	0.06 (1)	10.00				
17-10	0 / 288	0.0	0.0	0.12 (1)	10.00				
16-15	0 / 22	-17.5	-17.5	0.03 (4)	10.00				
15-14	0 / 0	-17.5	-17.5	0.04 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIG 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= $L/360$ (0.69")
 CALCULATED VERT. DEFL.(LL) = $L/999$ (0.05")
 ALLOWABLE DEFL.(TL)= $L/360$ (0.69")
 CALCULATED VERT. DEFL.(TL) = $L/999$ (0.10")

CSI: TC=0.61/1.00 (5-6:1), BC=0.25/1.00 (17-18:1)
WB=0.97/1.00 (7-21:1), SS=0.22/1.00 (2-3:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (19) (INPUT = 0.90)
JSI METAL= 0.31 (5) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**


CONTINUED ON PAGE 2



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
NE0818-098	T19	2	1	GREENPARK-MINNISALE HOMES-HEMLOCK 3 EL 1	PAGE 35 OF 38
Version 8.210 S Mar 12 2018 MITek Industries, Inc. Thu Aug 16 13:19:07 2018 Page 2 ID:eBbWLHt6nV_3L4qxDCn2pKz41l6-ZWh0UGrLALRA1oDUHwXZDB_ZJp7Upz1j21DAaCynH?					

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



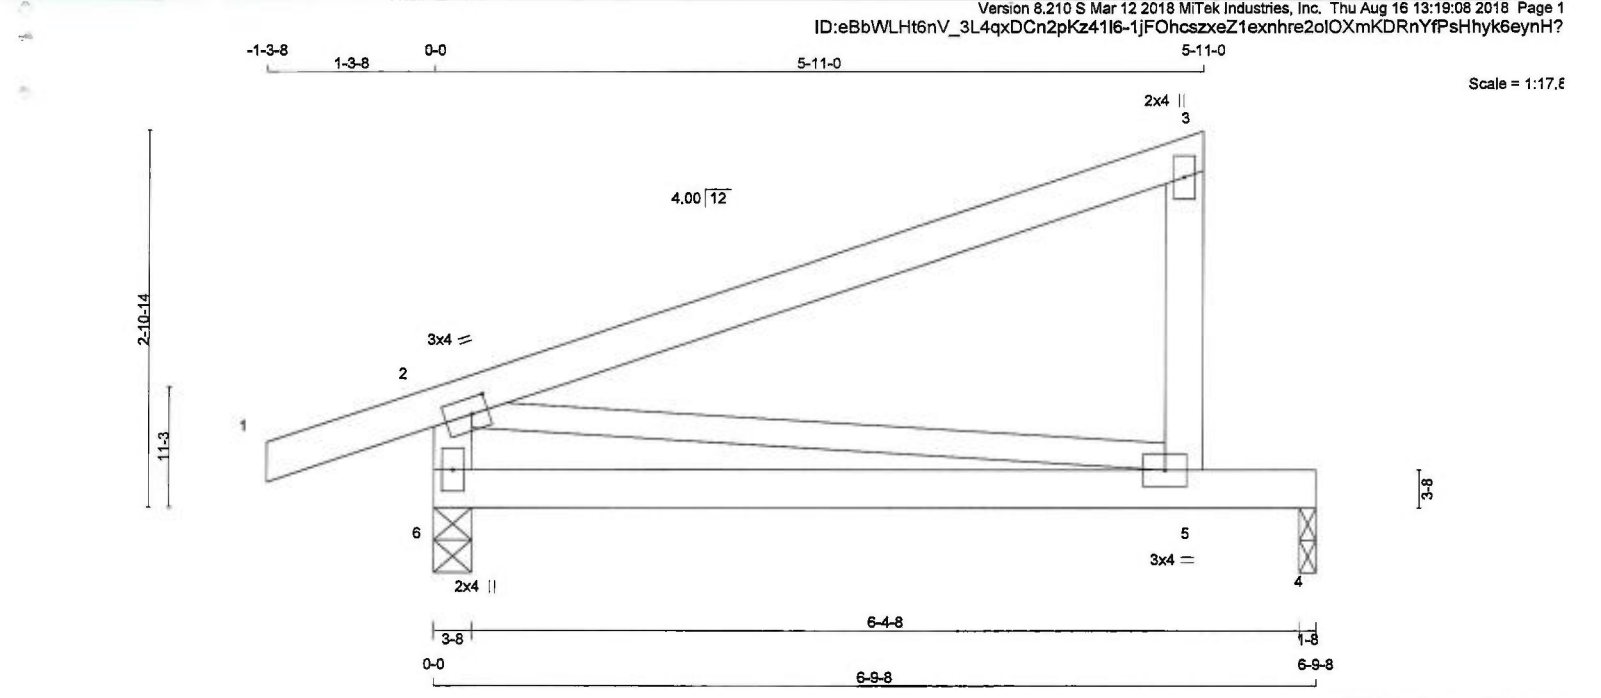

LUMBER

N. L. G. A. RULES

CHORDS

SIZE

LUMBER

DESCR.

SPF

1 - 3

2x4

DRY

No.2

5 - 3

2x4

DRY

No.2

6 - 2

2x4

DRY

No.2

6 - 4

2x4

DRY

No.2

ALL WEBS

2x3

DRY

No.2

DRY: SEASONED LUMBER.

SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT IN-SX	IN-SX
6	421	0	421	0	0	3-8
4	259	0	259	0	0	1-8

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED		MAX/MIN. SNOW		LIVE		PERM. LIVE	WIND	DEAD	SOIL
	SNOW	LIVE	SNOW	LIVE						
6	293	218 / 0	0 / 0	0 / 0	0 / 0	0 / 0	76 / 0	0 / 0		
4	183	120 / 0	0 / 0	0 / 0	0 / 0	0 / 0	63 / 0	0 / 0		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.

LL = 23.3 PSF

DL = 3.0 PSF

BOT CH.

LL = 0.0 PSF

DL = 7.0 PSF

TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, CBC 2012, ABC 2014

- CSA 086-09

- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.23")

CALCULATED VERT. DEFL.(LL) = L/999 (0.08")

ALLOWABLE DEFL.(TL)= L/360 (0.23")

CALCULATED VERT. DEFL.(TL) = L/391 (0.21")

CSI: TC=0.46/1.00 (2-3:1), BC=0.31/1.00 (5-6:1), WB=0.00/1.00 (2-5:1), SSI=0.20/1.00 (4-5:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR SECTION (PSI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
			822
			2284
			1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.30 (2) (INPUT = 0.90)

JSI METAL= 0.06 (6) (INPUT = 1.00)

TOTAL WEIGHT = 4 x 24 = 96 LBS

[M]IF

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMVW-t	MT20	3.0	4.0	1.50	1.50
3	TMV+p	MT20	2.0	4.0		
5	BMVW-t	MT20	3.0	4.0		
6	BMV1+p	MT20	2.0	4.0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 6, 4

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS					WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. (LC)	
FR-TO		FROM	TO		FR-TO			
1-2	0 / 16	-77.4	-77.4	0.10 (1)	10.00	2-5	0 / 0	0.00 (1)
2-3	0 / 0	-77.4	-77.4	0.46 (1)	10.00			
5-3	-229 / 0	0.0	0.0	0.03 (1)	7.81			
6-2	-332 / 0	0.0	0.0	0.03 (1)	7.81			
6-5	0 / 0	-17.5	-17.5	0.31 (1)	10.00			
5-4	0 / 0	-17.5	-17.5	0.30 (1)	10.00			



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.





BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B37579H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-09, section 10.9.4
10. This design is not valid after April 30, 2019.

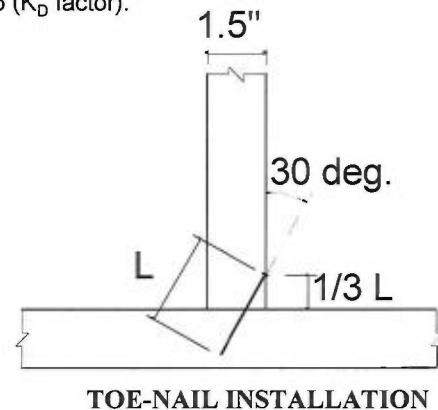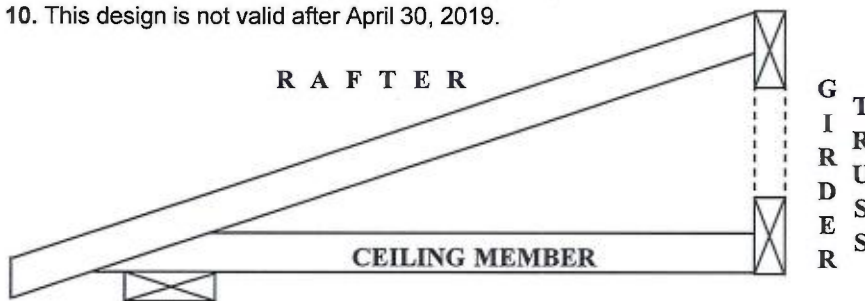

Nail type	Common wire	Common spiral	Common wire
Nail dia. (in)	0.160	0.152	0.144
	(3.5" nail)		(3" and 3.25" nail)
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS		
2X4 SPF	2	2	3
2X4 D. Fir	2	2	2
2X6 SPF	4	4	4
2X6 D. Fir	3	3	3



MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

PEO
Certificate No. 10889485



April 26, 2017

BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B37579H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind or earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-09, section 10.9.5
9. This design is not valid after April 30, 2019

Toe-nailing on 2x6 Bearing Plate

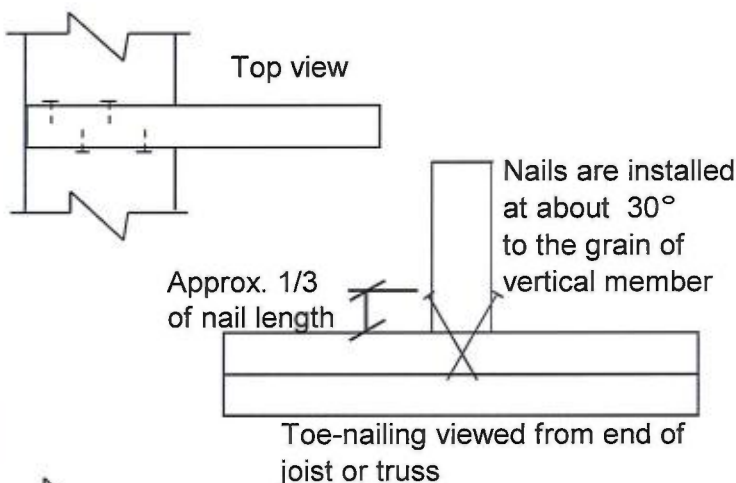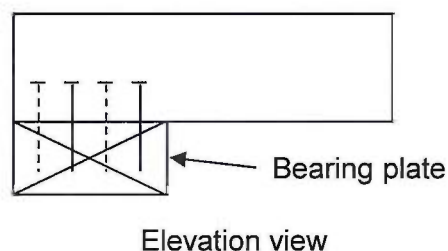

Toe-nailing on 2x4 Bearing Plate

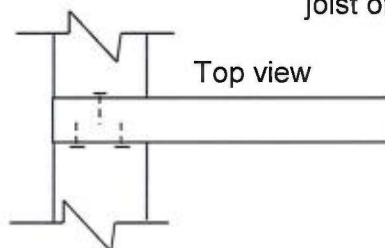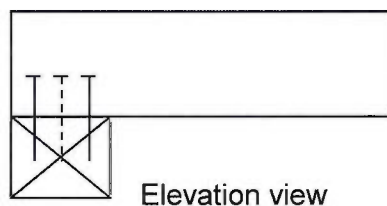


MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

PEO
Certificate No. 10889485



April 26, 2017

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.

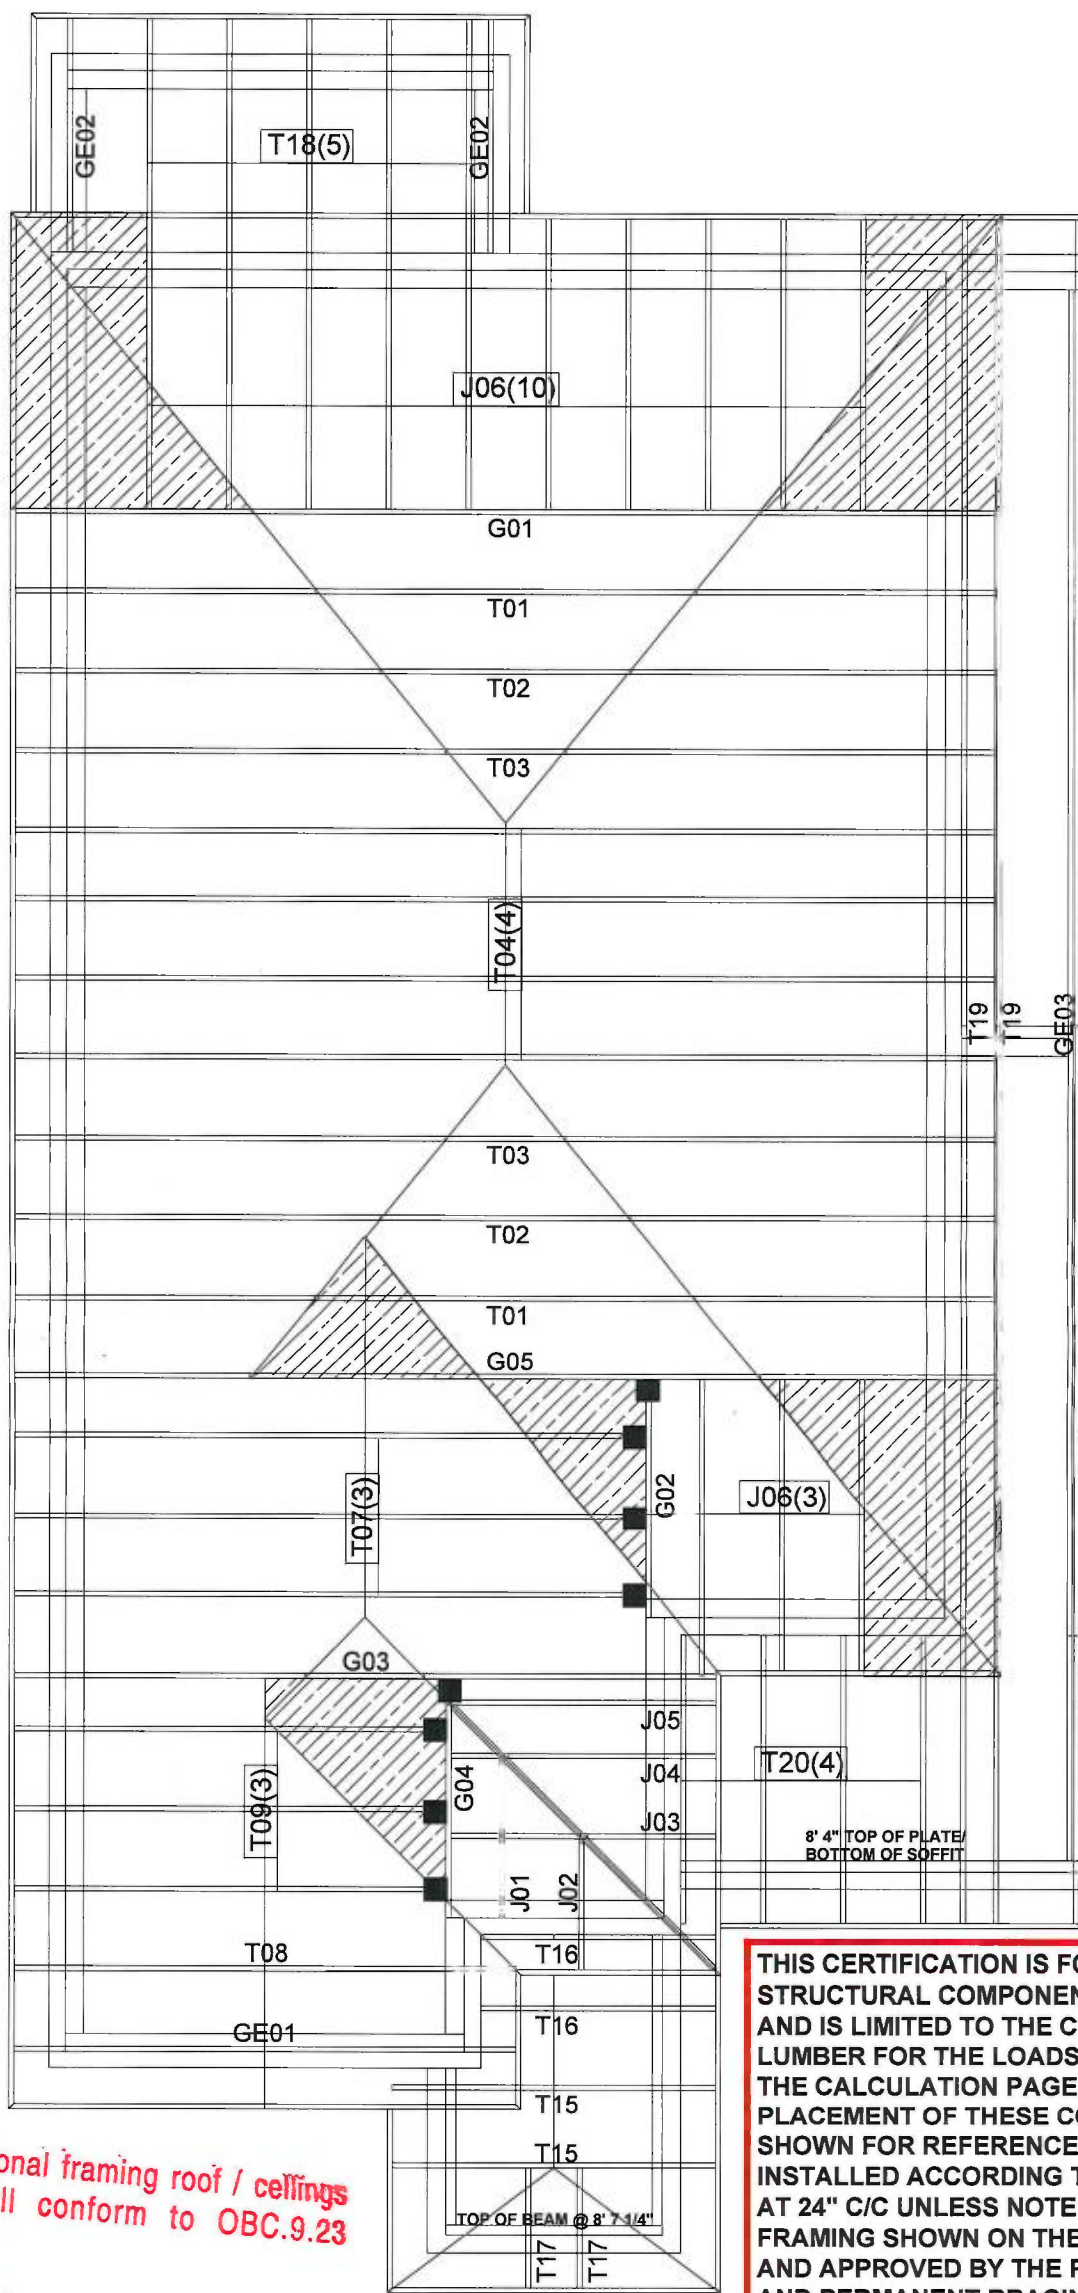

CITY OF BRAMPTON
BUILDING DIVISION
REVIEWED
FEB 07 2019
BY
MARY MARENETTE

For conventional framing roof / ceilings
framing shall conform to OBC.9.23

All work shall conform to the Ontario
Building Code O. Reg. 332/12 as amended

THIS CERTIFICATION IS FOR THE ENGINEERING REVIEW OF
STRUCTURAL COMPONENTS SHOWN ON THIS DRAWING
AND IS LIMITED TO THE COMPONENTS SUPPLIED BY KOTT
LUMBER FOR THE LOADS AND CONDITIONS SHOWN ON
THE CALCULATION PAGE OF EACH COMPONENT. THE
PLACEMENT OF THESE COMPONENTS ON THIS LAYOUT IS
SHOWN FOR REFERENCE ONLY. ROOF TRUSSES MUST BE
INSTALLED ACCORDING TO MANUFACTURER'S GUIDELINES
AT 24" C/C UNLESS NOTED OTHERWISE. CONVENTIONAL
FRAMING SHOWN ON THE LAYOUT MUST BE DESIGNED
AND APPROVED BY THE PROJECT ENGINEER. TEMPORARY
AND PERMANENT BRACINGS OF THE ROOF AND BUILDING
ARE THE RESPONSIBILITY OF THE PROJECT ENGINEER
AND TO CONFORM TO BCSI GUIDELINES.

LOT 12 L

Architectural Drawing Info:
Date: JULY 23, 2018
Project number: 18012
Model: HEMLOCK 3



CONVENTIONAL
FRAMING BY OTHERS

ALL CONVENTIONAL FRAMING TO CONFORM WITH
PART 9 OF THE O.B.C.
ROOF RAFTERS THAT CROSS MEET OVER TRUSSES
TO BE 2x4 S.P.F. @ 24" O/C WITH A 2x4 VERTICAL
POST TO THE TRUSS UNDERNEATH EACH CROSS
POINT. VERTICAL POST LONGER THAN 6' TO HAVE
LATERAL BRACING SO THAT THE DISTANCE BETWEEN
END POINT AND BETWEEN ROWS OF BRACING
DOES NOT EXCEED 6'.

SIZE AND LOCATION OF CONVENTIONAL FRAMING
IS APPROXIMATE. ALL AREAS MAY NOT BE SHOWN.
REFER TO ARCHITECTURAL PLANS FOR DETAILS.

HANGER LEGEND:

- ▼ LUS24
- LJS26DS
- HGUS26
- ✕ HGUS26-2

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3 PSF
BOT CH. LL = 0 PSF
DL = 7 PSF
TOTAL LOAD = 33.3 PSF
SPACING = 24" O/C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCB 2012, ABC 2014
- CSA 086-09
- TPIC 2011

Model: HEMLOCK 3 EL 1

Customer: GREENPARK

Project: MINNISALE HOMES

Location: BRAMPTON

Date: 6/22/2018 Drawn by: BB