


Products				
PlotID	Length	Product	Plies	Net Qty
J1	14-00-00	9 1/2" NI-40x	1	16
J1DJ	14-00-00	9 1/2" NI-40x	2	6
J2	12-00-00	9 1/2" NI-40x	1	2
J3	10-00-00	9 1/2" NI-40x	1	27
J3DJ	10-00-00	9 1/2" NI-40x	2	2
J4	6-00-00	9 1/2" NI-40x	1	10
J5	4-00-00	9 1/2" NI-40x	1	4
J6	2-00-00	9 1/2" NI-40x	1	2
B1	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B4	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B2	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B7	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B3	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B5	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP		

Connector Summary		
Qty	Manuf	Product
2	H1	IUS2.56/9.5
9	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
5	H1	IUS2.56/9.5
1	H2	HU310-2
1	H3	HUS1.81/10

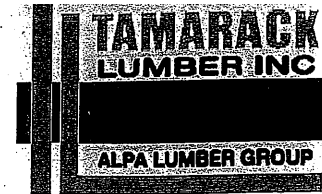

FROM PLAN DATED: SEPT 2017

BUILDER: GREEN PARK HOMES

SITE: SECONDO VALES ESTATES

MODEL: HOLLAND 9E

ELEVATION: 1

LOT:

CITY: EAST GWILLIMBURY

SALESMAN: M D

DESIGNER: AJ

REVISION: lbv

NOTES:

REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION.

SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. MULTIPLE SQUASH BLOCKS REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. CANTILEVERED JOISTS INCLUDING CANT' OVER BRICK REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR HOLES INCLUDING DUCT CHASE AND FIELD CUT OPENINGS SEE FIGURE 7, TABLES 1 & 2. CERAMIC TILE APPLICATION AS PER O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft<sup>2</sup>


DEAD LOAD: 15.0 lb/ft<sup>2</sup>

TILED AREAS: 20 lb/ft

SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 2017-11-24

1st FLOOR

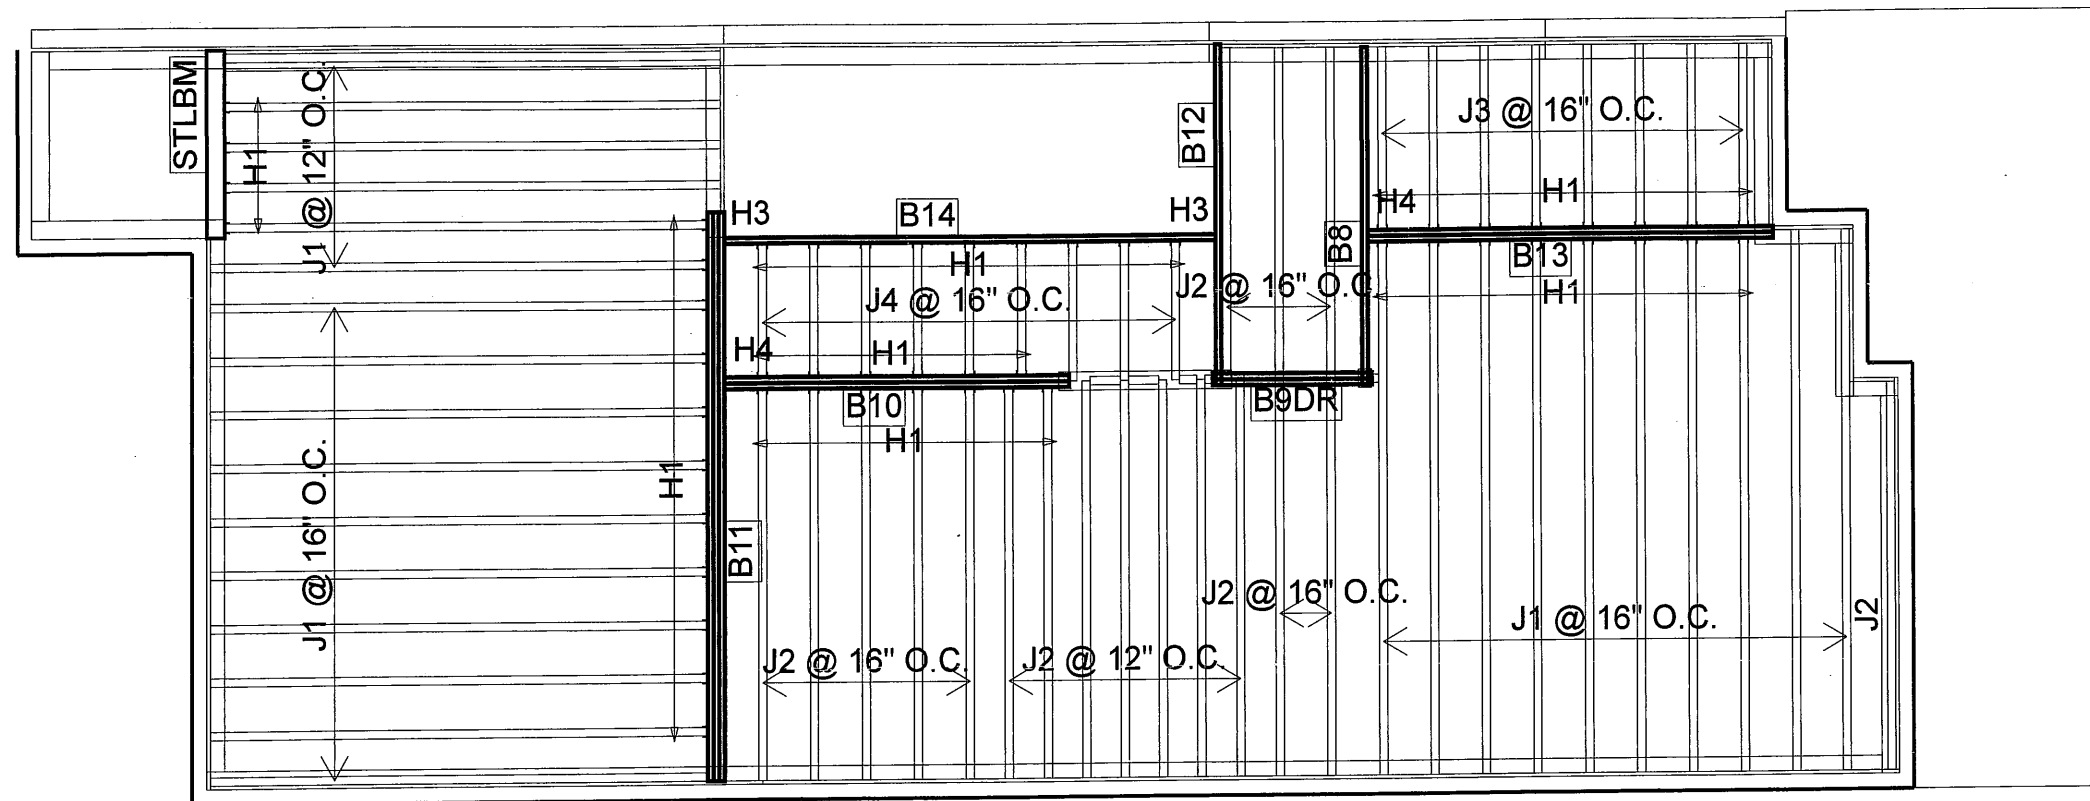

Products					Connector Summary		
PlotID	Length	Product	Plies	Net Qty	Qty	Manuf	Product
J1	14-00-00	9 1/2" NI-40x	1	26	9	H1	IUS2.56/9.5
J2	10-00-00	9 1/2" NI-40x	1	18	29	H1	IUS2.56/9.5
J3	6-00-00	9 1/2" NI-40x	1	8	11	H1	IUS2.56/9.5
J4	4-00-00	9 1/2" NI-40x	1	9	4	H1	IUS2.56/9.5
B11	16-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3	1	H3	HUS1.81/10
B14	14-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	1	H3	HUS1.81/10
B13	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	1	H4	HGUS410
B12	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	1	H4	HGUS410
B8	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1			
B10	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2			
B9DR	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2			

FROM PLAN DATED: SEPT 2017

BUILDER: GREEN PARK HOMES

SITE: SECONDO VALES ESTATES

MODEL: HOLLAND 9E

ELEVATION: 1

LOT:

CITY: EAST GWILLIMBURY

SALESMAN: M D

DESIGNER: AJ

REVISION: lbv

NOTES:

REFER TO THE NORDIC **INSTALLATION GUIDE** FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft<sup>2</sup>

DEAD LOAD: 15.0 lb/ft<sup>2</sup>

TILED AREAS: 20 lb/ft

SUBFLOOR: 5/8" GLUED AND NAILED

DATE: 2017-11-24

**2nd FLOOR**



# Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B1(i1328)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

November 24, 2017 11:05:16

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: EAST GWILLIMBURY,

Customer:

Code reports: CCMC 12472-R

File Name: HOLLAND 9E.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B1(i1328)

Specifier:

Designer: AJ

Company:

Misc:

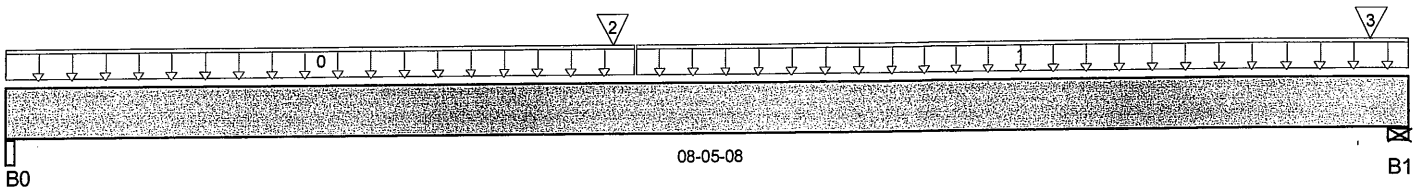

Total Horizontal Product Length = 08-05-08

## Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 2-3/4"	455 / 0	263 / 0		
B1, 3-1/2"	334 / 0	211 / 0		

## Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	03-09-08	27	13			n/a
1	FC1 Floor Material	Unf. Lin. (lb/ft)	L	03-09-08	08-05-08	5	2			n/a
2	B2(i1384)	Conc. Pt. (lbs)	L	03-07-12	03-07-12	649	352			n/a
3	E12(i878)	Conc. Pt. (lbs)	L	08-02-12	08-02-12	15	19			n/a

Controls Summary	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	3,099 ft-lbs	12,704 ft-lbs	24.4%	1	03-07-12
End Shear	947 lbs	5,785 lbs	16.4%	1	01-00-04
Total Load Defl.	L/999 (0.084")	n/a	n/a	4	04-00-03
Live Load Defl.	L/999 (0.053")	n/a	n/a	5	04-00-03
Max Defl.	0.084"	n/a	n/a	4	04-00-03
Span / Depth	10.2	n/a	n/a		00-00-00

## Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Beam	2-3/4" x 1-3/4"	1,011 lbs	39.3%	17.2%	Unspecified
B1 Wall/Plate	3-1/2" x 1-3/4"	764 lbs	23.4%	10.2%	Unspecified

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.  
 Design meets Code minimum (L/360) Live load deflection criteria.  
 Calculations assume member is fully braced.  
 Resistance Factor phi has been applied to all presented results per CSA O86.  
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.  
 Design based on Dry Service Condition.  
 Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.





# Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B2(i1384)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

November 24, 2017 11:05:14

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: EAST GWILLIMBURY,

Customer:

Code reports: CCMC 12472-R

File Name: HOLLAND 9E.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B2(i1384)

Specifier:

Designer: AJ

Company:

Misc:

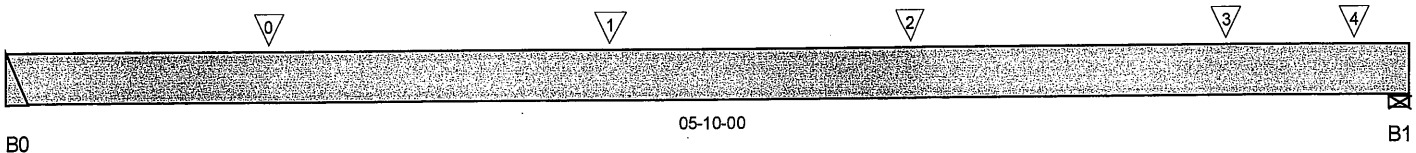

Total Horizontal Product Length = 05-10-00

## Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0	659 / 0	358 / 0		
B1, 3-1/2"	2,811 / 0	1,523 / 0		

## Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	J1(i975)	Conc. Pt. (lbs)	L	01-01-00	01-01-00	345	173			n/a
1	J1DJ(i1318)	Conc. Pt. (lbs)	L	02-06-00	02-06-00	389	195			n/a
2	J1(i1279)	Conc. Pt. (lbs)	L	03-09-00	03-09-00	357	179			n/a
3	J1(i1336)	Conc. Pt. (lbs)	L	05-01-00	05-01-00	369	184			n/a
4	E2(i877)	Conc. Pt. (lbs)	L	05-07-04	05-07-04	2,010	1,094			n/a

## Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	2,360 ft-lbs	25,408 ft-lbs	9.3%	1	02-06-00
End Shear	1,424 lbs	11,571 lbs	12.3%	1	00-11-08
Total Load Defl.	L/999 (0.018")	n/a	n/a	4	02-10-11
Live Load Defl.	L/999 (0.012")	n/a	n/a	5	02-10-11
Max Defl.	0.018"	n/a	n/a	4	02-10-11
Span / Depth	6.9	n/a	n/a		00-00-00

## Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Hanger	2" x 3-1/2"	1,435 lbs	n/a	16.8%	Hanger
B1 Wall/Plate	3-1/2" x 3-1/2"	6,121 lbs	93.6%	41%	Unspecified

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.


Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

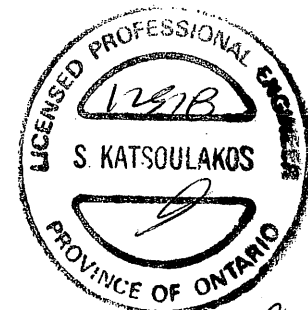

DWG NO. TAM 5383-18  
STRUCTURAL  
COMPONENT ONLY



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B2(i1384)**

Dry | 1 span | No cantilevers | 0/12 slope (deg)

November 24, 2017 11:05:14

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: EAST GWILLIMBURY,

Customer:

Code reports: CCMC 12472-R

File Name: HOLLAND 9E.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B2(i138

Specifier:

Designer: AJ

Company:

Misc:

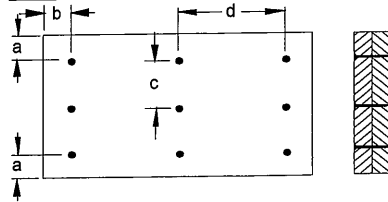**Connection Diagram**

a minimum = 2"      c = 2-3/4"  
 b minimum = 3"      d = 6"

Calculated Side Load = 532.1 lb/ft


Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Nails

**3-1/2" ARDOX SPIRAL****Disclosure**

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

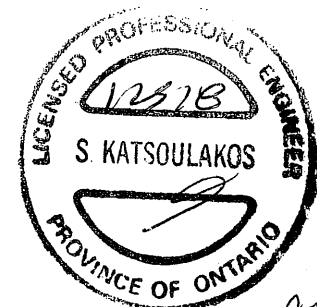

DWG NO. TAM 5383-18  
 STRUCTURAL  
 COMPONENT ONLY



# Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basment\Flush Beams\B3(i1268)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

November 24, 2017 11:05:06

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: EAST GWILLIMBURY,

Customer:

Code reports: CCMC 12472-R

File Name: HOLLAND 9E.mmdl


Description: Designs\Flush Beams\Basment\Flush Beams\B3(i1268)

Specifier:

Designer: AJ

Company:

Misc:

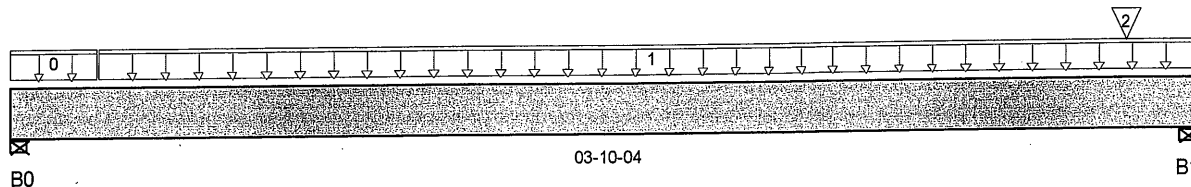

Total Horizontal Product Length = 03-10-04

## Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	16 / 0	17 / 0		
B1, 3-1/2"	81 / 0	67 / 0		

## Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	00-03-08	7	4			n/a
1	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-03-08	03-10-04	9	4			n/a
2	E12(i878)	Conc. Pt. (lbs)	L	03-07-08	03-07-08	64	49			n/a

## Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	35 ft-lbs	12,704 ft-lbs	0.3%	1	01-11-02
End Shear	21 lbs	5,785 lbs	0.4%	1	01-01-00
Total Load Defl.	L/999 (0")	n/a	n/a	4	01-11-02
Live Load Defl.	L/999 (0")	n/a	n/a	5	01-11-02
Max Defl.	0"	n/a	n/a	4	01-11-02
Span / Depth	4.3	n/a	n/a		00-00-00

## Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

## Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Wall/Plate	3-1/2" x 1-3/4"	47 lbs	1.4%	0.6%	Unspecified
B1 Wall/Plate	3-1/2" x 1-3/4"	205 lbs	6.3%	2.7%	Unspecified

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCK®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.





# Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B4(i900)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

November 24, 2017 11:05:08

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: EAST GWILLIMBURY,

Customer:

Code reports: CCMC 12472-R

File Name: HOLLAND 9E.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B4(i900)

Specifier:

Designer: AJ

Company:

Misc:

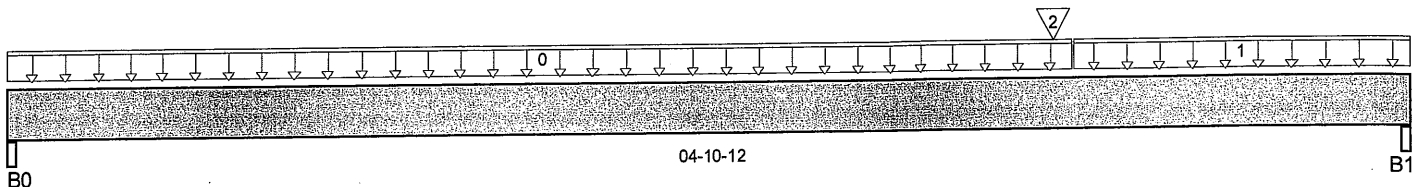

Total Horizontal Product Length = 04-10-12

## Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 2-3/4"	184 / 0	105 / 0		
B1, 1-3/4"	407 / 0	220 / 0		

## Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	03-08-12	27	13			n/a
1	FC1 Floor Material	Unf. Lin. (lb/ft)	L	03-08-12	04-10-12	9	5			n/a
2	B5(i902)	Conc. Pt. (lbs)	L	03-07-14	03-07-14	480	247			n/a

## Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	1,003 ft-lbs	12,704 ft-lbs	7.9%	1	03-07-14
End Shear	861 lbs	5,785 lbs	14.9%	1	03-11-08
Total Load Defl.	L/999 (0.009")	n/a	n/a	4	02-08-00
Live Load Defl.	L/999 (0.006")	n/a	n/a	5	02-09-00
Max Defl.	0.009"	n/a	n/a	4	02-08-00
Span / Depth	5.9	n/a	n/a		00-00-00

## Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Beam	2-3/4" x 1-3/4"	407 lbs	15.8%	6.9%	Unspecified
B1 Beam	1-3/4" x 1-3/4"	885 lbs	26.5%	23.7%	Unspecified

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

## Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALC®, BC FRAMER®, AJST™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.





# Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B5(1902)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

November 24, 2017 11:05:09

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: EAST GWILLIMBURY,

Customer:

Code reports:

CCMC 12472-R

File Name: HOLLAND 9E.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B5(1902)

Specifier:

Designer: AJ

Company:

Misc:

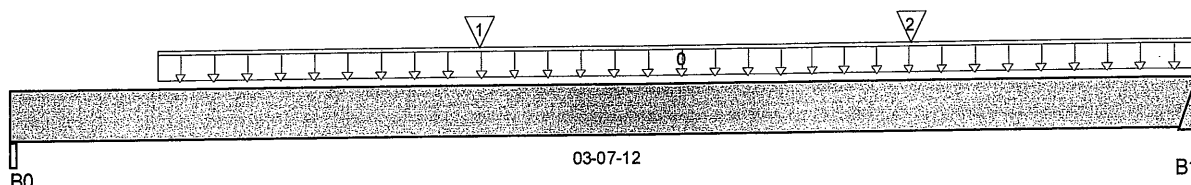

Total Horizontal Product Length = 03-07-12

## Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 5-1/2"	449 / 0	234 / 0		
B1	496 / 0	256 / 0		

## Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	STAIR	Unf. Lin. (lb/ft)	L	00-05-08	03-07-12	240	120			n/a
1	J5(1965)	Conc. Pt. (lbs)	L	01-05-04	01-05-04	86	43			n/a
2	J5(1988)	Conc. Pt. (lbs)	L	02-09-04	02-09-04	85	42			n/a

## Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	805 ft-lbs	12,704 ft-lbs	6.3%	1	01-11-06
End Shear	549 lbs	5,785 lbs	9.5%	1	02-08-04
Total Load Defl.	L/999 (0.004")	n/a	n/a	4	01-11-13
Live Load Defl.	L/999 (0.003")	n/a	n/a	5	01-11-13
Max Defl.	0.004"	n/a	n/a	4	01-11-13
Span / Depth	4	n/a	n/a		00-00-00

## Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

## Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Beam	5-1/2" x 1-3/4"	965 lbs	18.8%	8.2%	Unspecified
B1 Hanger	2" x 1-3/4"	1,063 lbs	n/a	24.9%	HUS1.81/10

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

DWG NO. TAM 5386-18  
STRUCTURAL  
COMPONENT ONLY







## Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Basment\...\B6(i903)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

November 24, 2017 11:05:18

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: EAST GWILLIMBURY,

Customer:

Code reports:

CCMC 12472-R

File Name: HOLLAND 9E.mmdl


Description: Designs\Dropped Beams\Basment\Dropped Beams\B6(i

Specifier:

Designer: AJ

Company:

Misc:

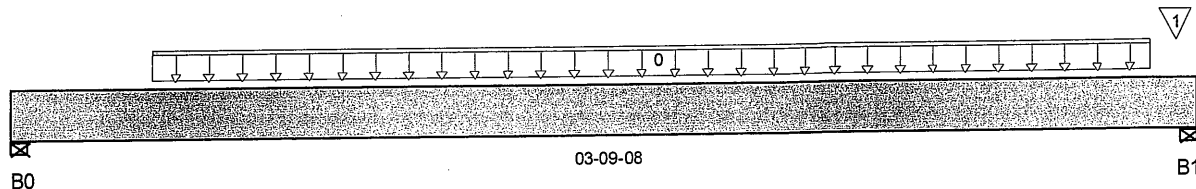

Total Horizontal Product Length = 03-09-08

## Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 5-1/2"	383 / 0	201 / 0		
B1, 1-3/4"	800 / 0	425 / 0		

## Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	STAIR	Unf. Lin. (lb/ft)	L	00-05-08	03-07-12	240	120			n/a
1	B4(i900)	Conc. Pt. (lbs)	L	03-08-10	03-08-10	417	225			n/a

## Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	707 ft-lbs	10,937 ft-lbs	6.5%	1	02-00-10
End Shear	414 lbs	5,785 lbs	7.2%	1	01-03-00
Total Load Defl.	L/999 (0.004")	n/a	n/a	4	02-00-10
Live Load Defl.	L/999 (0.003")	n/a	n/a	5	02-00-10
Max Defl.	0.004"	n/a	n/a	4	02-00-10
Span / Depth	4.2	n/a	n/a		00-00-00

## Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

## Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Wall/Plate	5-1/2" x 1-3/4"	825 lbs	10.6%	7%	Unspecified
B1 Wall/Plate	1-3/4" x 1-3/4"	1,731 lbs	69.6%	46.3%	Unspecified

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume unbraced length of Top: 03-02-04, Bottom: 03-02-04.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

DWG NO. TAM 5387-18  
STRUCTURAL  
COMPONENT ONLY



# Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B7(i1267)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

November 24, 2017 11:05:11

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: EAST GWILLIMBURY,

Customer:

Code reports: CCMC 12472-R

File Name: HOLLAND 9E.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B7(i1267)

Specifier:

Designer: AJ

Company:

Misc:

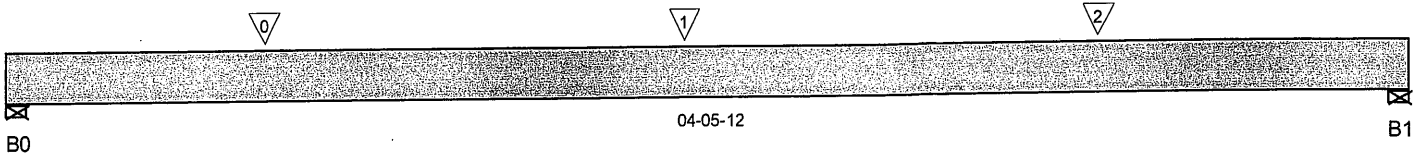

Total Horizontal Product Length = 04-05-12

## Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 2-3/8"	706 / 0	374 / 0		
B1, 2-3/8"	637 / 0	339 / 0		

## Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	-	Conc. Pt. (lbs)	L	00-09-14	00-09-14	445	222			n/a
1	-	Conc. Pt. (lbs)	L	02-01-14	02-01-14	468	234			n/a
2	-	Conc. Pt. (lbs)	L	03-05-14	03-05-14	425	212			n/a

## Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	1,782 ft-lbs	25,408 ft-lbs	7%	1	02-01-14
End Shear	1,367 lbs	11,571 lbs	11.8%	1	03-05-14
Total Load Defl.	L/999 (0.008")	n/a	n/a	4	02-02-14
Live Load Defl.	L/999 (0.005")	n/a	n/a	5	02-02-14
Max Defl.	0.008"	n/a	n/a	4	02-02-14
Span / Depth	5.3	n/a	n/a		00-00-00

Bearing Supports	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Wall/Plate	2-3/8" x 3-1/2"	1,527 lbs	34.4%	15.1%	Unspecified
B1 Wall/Plate	2-3/8" x 3-1/2"	1,379 lbs	31.1%	13.6%	Unspecified

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012



DWG NO. TAM 5368-18  
STRUCTURAL  
COMPONENT ONLY



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B7(i1267)**

Dry | 1 span | No cantilevers | 0/12 slope (deg)

November 24, 2017 11:05:11

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: EAST GWILLIMBURY,

Customer:

Code reports:

CCMC 12472-R

File Name: HOLLAND 9E.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B7(i126

Specifier:

Designer: AJ

Company:

Misc:

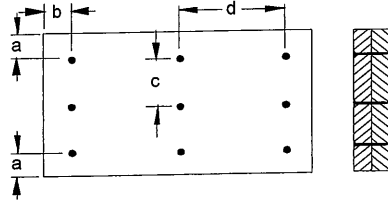**Connection Diagram**

a minimum = 2" c = 2-3/4"

b minimum = 3" d = 6"

Calculated Side Load = 485.5 lb/ft


Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Nails

**3-1/2" ARDOX SPIRAL****Disclosure**

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

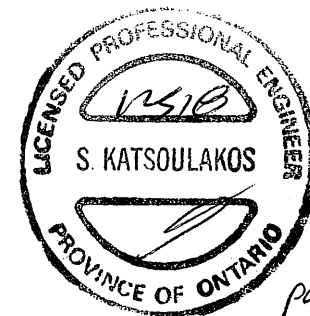

DWG NO. TAM 5388-18  
STRUCTURAL  
COMPONENT ONLY



# Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP 1st Floor\Flush Beams\B8(i1375)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

November 24, 2017 11:05:01

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: EAST GWILLIMBURY,

Customer:

Code reports: CCMC 12472-R

File Name: HOLLAND 9E.mmdl


Description: Designs\Flush Beams\1st Floor\Flush Beams\B8(i1375)

Specifier:

Designer: AJ

Company:

Misc:

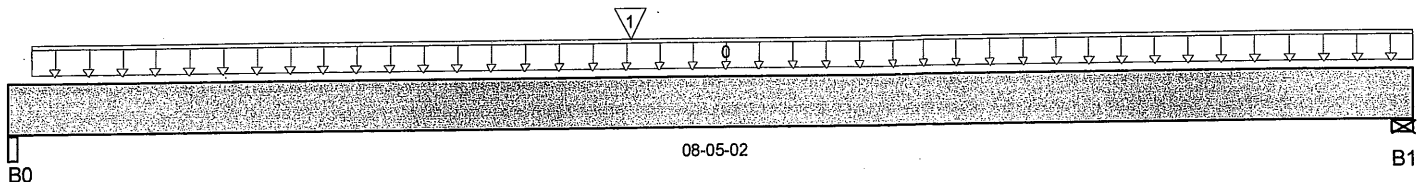

Total Horizontal Product Length = 08-05-02

## Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	1,125 / 0	610 / 0		
B1, 4-3/8"	915 / 0	499 / 0		

## Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-01-11	08-05-02	26	14			n/a
1	B13(i1416)	Conc. Pt. (lbs)	L	03-08-08	03-08-08	1,819	958			n/a

## Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	8,120 ft-lbs	12,704 ft-lbs	63.9%	1	03-08-08
End Shear	2,391 lbs	5,785 lbs	41.3%	1	01-01-00
Total Load Defl.	L/454 (0.209")	0.395"	52.9%	4	04-00-08
Live Load Defl.	L/698 (0.136")	0.263"	51.6%	5	04-00-08
Max Defl.	0.209"	n/a	n/a	4	04-00-08
Span / Depth	10	n/a	n/a		00-00-00

## Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

## Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Beam	3-1/2" x 1-3/4"	2,451 lbs	36.7%	32.8%	Unspecified
B1 Wall/Plate	4-3/8" x 1-3/4"	1,996 lbs	48.8%	21.4%	Unspecified

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.  
 Design meets Code minimum (L/360) Live load deflection criteria.  
 Calculations assume member is fully braced.  
 Resistance Factor phi has been applied to all presented results per CSA O86.  
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.  
 Design based on Dry Service Condition.  
 Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012





# Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP 1st Floor...\B9DR(i1352)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

November 24, 2017 11:05:04

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: EAST GWILLIMBURY,

Customer:

Code reports: CCMC 12472-R

File Name: HOLLAND 9E.mmdl


Description: Designs\Dropped Beams\1st Floor\Dropped Beams\B9D

Specifier:

Designer: AJ

Company:

Misc:

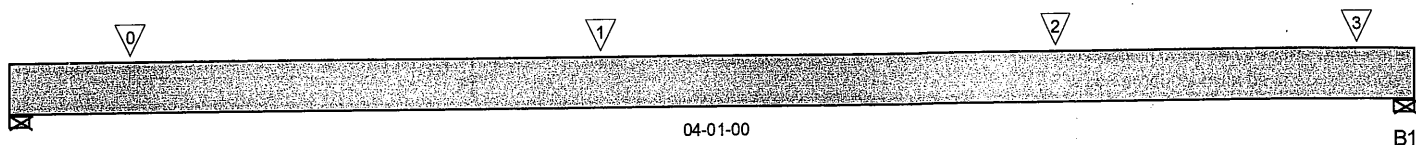

Total Horizontal Product Length = 04-01-00

## Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 6"	1,048 / 0	580 / 0		
B1, 4"	1,643 / 0	887 / 0		

## Load Summary

Tag Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0 -	Conc. Pt. (lbs)	L	00-04-02	00-04-02	688	380			n/a
1 -	Conc. Pt. (lbs)	L	01-08-08	01-08-08	442	220			n/a
2 -	Conc. Pt. (lbs)	L	03-00-08	03-00-08	437	218			n/a
3 B8(i1375)	Conc. Pt. (lbs)	L	03-11-00	03-11-00	1,124	609			n/a

## Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	1,098 ft-lbs	25,408 ft-lbs	4.3%	1	01-08-08
End Shear	1,015 lbs	11,571 lbs	8.8%	1	02-11-08
Total Load Defl.	L/999 (0.003")	n/a	n/a	4	02-01-09
Live Load Defl.	L/999 (0.002")	n/a	n/a	5	02-01-09
Max Defl.	0.003"	n/a	n/a	4	02-01-09
Span / Depth	4.3	n/a	n/a		00-00-00

## Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Wall/Plate	6" x 3-1/2"	2,296 lbs	13.5%	9%	Unspecified
B1 Wall/Plate	4" x 3-1/2"	3,574 lbs	31.4%	20.9%	Unspecified

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume unbraced length of Top: 00-02-09, Bottom: 00-02-09.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012



DWG NO. TAM 5390-13  
STRUCTURAL  
COMPONENT ONLY

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: EAST GWILLIMBURY,

Customer:

Code reports: CCMC 12472-R

File Name: HOLLAND 9E.mmdl

Description: Designs\Dropped Beams\1st Floor\Dropped Beams\B


Specifier:

Designer: AJ

Company:

Msc:

Connection Diagram

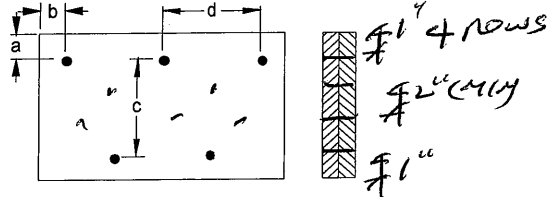

a minimum = 1" c = 7-1/2"  
b minimum = 3" d = 6"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Member has no side loads.

Connectors are: 16d Spiker Nails

3-1/2" ARDOX SPIRAL

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.




DWG NO. TAM 5390-18  
STRUCTURAL  
COMPONENT ONLY

**BC CALC® Design Report**


Build 5033  
 Job Name:  
 Address:  
 City, Province, Postal Code: EAST GWILLIMBURY,  
 Customer:  
 Code reports: CCMC 12472-R

File Name: HOLLAND 9E.mmdl  
 Description: Designs\Flush Beams\1st Floor\Flush Beams\B10(i1349)  
 Specifier:  
 Designer: AJ  
 Company:  
 Misc:

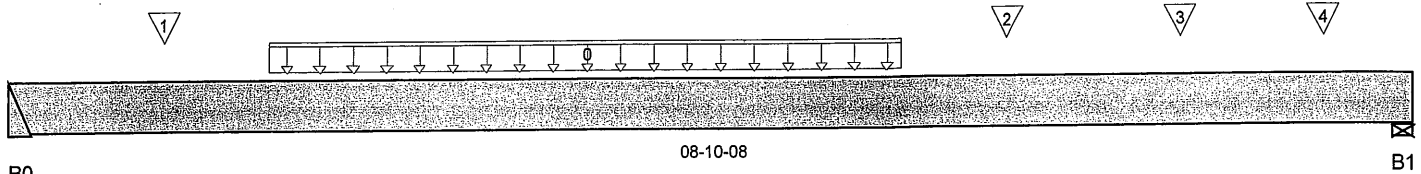

Total Horizontal Product Length = 08-10-08

**Reaction Summary (Down / Uplift) ( lbs )**

Bearing	Live	Dead	Snow	Wind
B0	1,075 / 0	580 / 0		
B1, 3-1/4"	1,154 / 0	619 / 0		

**Load Summary**

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	Smoothed Load	Unf. Lin. (lb/ft)	L	01-07-12	05-07-12	268	134			n/a
1	-	Conc. Pt. (lbs)	L	00-11-12	00-11-12	340	170			n/a
2	-	Conc. Pt. (lbs)	L	06-03-12	06-03-12	326	162			n/a
3	-	Conc. Pt. (lbs)	L	07-05-01	07-05-01	293	146			n/a
4	J2(i1404)	Conc. Pt. (lbs)	L	08-03-12	08-03-12	196	98			n/a

**Controls Summary**

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	5,314 ft-lbs	25,408 ft-lbs	20.9%	1	04-11-12
End Shear	2,326 lbs	11,571 lbs	20.1%	1	00-11-08
Total Load Defl.	L/999 (0.1")	n/a	n/a	4	04-04-12
Live Load Defl.	L/999 (0.065")	n/a	n/a	5	04-04-12
Max Defl.	0.1"	n/a	n/a	4	04-04-12
Span / Depth	10.8	n/a	n/a		00-00-00

**Bearing Supports**

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Hanger	2" x 3-1/2"	2,337 lbs	n/a	27.4%	HGUS410
B1 Wall/Plate	3-1/4" x 3-1/2"	2,504 lbs	41.2%	18%	Unspecified

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.  
 Design meets Code minimum (L/360) Live load deflection criteria.  
 Calculations assume member is fully braced.  
 Hanger Manufacturer: Unassigned  
 Resistance Factor phi has been applied to all presented results per CSA O86.  
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.  
 Design based on Dry Service Condition.  
 Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012



DWG NO. TAM 5391-18  
 STRUCTURAL  
 COMPONENT ONLY



# Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP 1st Floor\...\B10(i1349)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

November 24, 2017 11:04:58

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: EAST GWILLIMBURY,

Customer:

Code reports: CCMC 12472-R

File Name: HOLLAND 9E.mmdl

Description: Designs\Flush Beams\1st Floor\Flush Beams\B10(i1349)


Specifier:

Designer: AJ

Company:

Misc:

## Connection Diagram

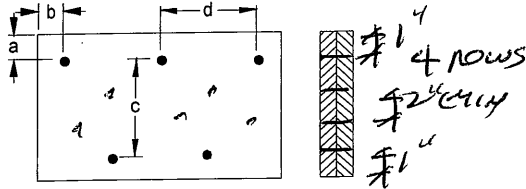

a minimum = 1" c = 1-1/2"  
b minimum = 3" d = 6"

Calculated Side Load = 395.7 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Common Nails

3-1/2" ARDOX SPIRAL

## Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



per

DWG NO. TAM 5391 -18  
STRUCTURAL  
COMPONENT ONLY





Boise Cascade

## Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP 1st Floor\Flush Beams\B11(i1350)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

November 24, 2017 11:04:52

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: EAST GWILLIMBURY,

Customer:

Code reports:

CCMC 12472-R

File Name: HOLLAND 9E.mmdl


Description: Designs\Flush Beams\1st Floor\Flush Beams\B11(i1350)

Specifier:

Designer: AJ

Company:

Misc:

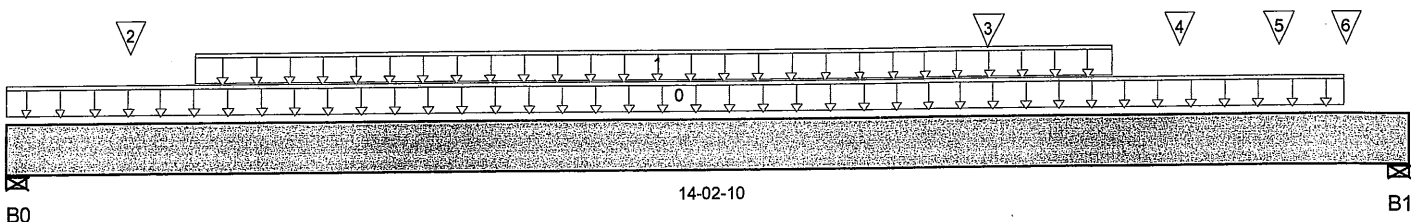

Total Horizontal Product Length = 14-02-10

## Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 4-3/8"	2,112 / 0	1,169 / 0		
B1, 7-1/2"	3,953 / 0	2,140 / 0		

## Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	13-06-14	24	12			n/a
1	Smoothed Load	Unf. Lin. (lb/ft)	L	01-10-14	11-02-14	260	130			n/a
2	J1 (i1305)	Conc. Pt. (lbs)	L	01-02-14	01-02-14	320	160			n/a
3	B10 (i1349)	Conc. Pt. (lbs)	L	09-11-06	09-11-06	1,065	574			n/a
4	J1 (i1325)	Conc. Pt. (lbs)	L	11-10-14	11-10-14	303	151			n/a
5	J1 (i1330)	Conc. Pt. (lbs)	L	12-10-14	12-10-14	259	130			n/a
6	-	Conc. Pt. (lbs)	L	13-06-15	13-06-15	1,368	713			n/a

## Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	18,714 ft-lbs	39,636 ft-lbs	47.2%	1	07-10-14
End Shear	5,840 lbs	17,356 lbs	33.6%	1	12-09-10
Total Load Defl.	L/283 (0.565")	0.668"	84.7%	4	07-02-14
Live Load Defl.	L/439 (0.365")	0.445"	82.1%	5	07-02-14
Max Defl.	0.565"	n/a	n/a	4	07-02-14
Span / Depth	16.9	n/a	n/a		00-00-00

## Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Wall/Plate	4-3/8" x 5-1/4"	4,629 lbs	37.7%	16.5%	Unspecified
B1 Wall/Plate	7-1/2" x 5-1/4"	8,604 lbs	40.9%	17.9%	Unspecified

## Notes





## BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: EAST GWILLIMBURY,

Customer:

Code reports: CCMC 12472-R

File Name: HOLLAND 9E.mmdl

Description: Designs\Flush Beams\1st Floor\Flush Beams\B11(i1350)

Specifier:

Designer: AJ

Company:

Misc:

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9


CONFORMS TO OBC 2012

## Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

## Connection Diagram

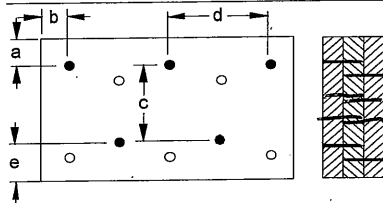

a minimum = 1"

c = 6 1/2"

b minimum = 3"

d = 6"

e minimum = 2"

Calculated Side Load = 532.9 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

Connectors are: 16d <sup>hooker</sup> Nails

3-1/2" ARDOX SPIRAL



DWG NO. TAM 5392-18  
STRUCTURAL  
COMPONENT ONLY



Boise Cascade

## Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP 1st Floor\Flush Beams\B12(i1335)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

November 24, 2017 11:04:57

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code:EAST GWILLIMBURY,

Customer:

Code reports: CCMC 12472-R

File Name: HOLLAND 9E.mmdl


Description: Designs\Flush Beams\1st Floor\Flush Beams\B12(i1335)

Specifier:

Designer: AJ

Company:

Misc:

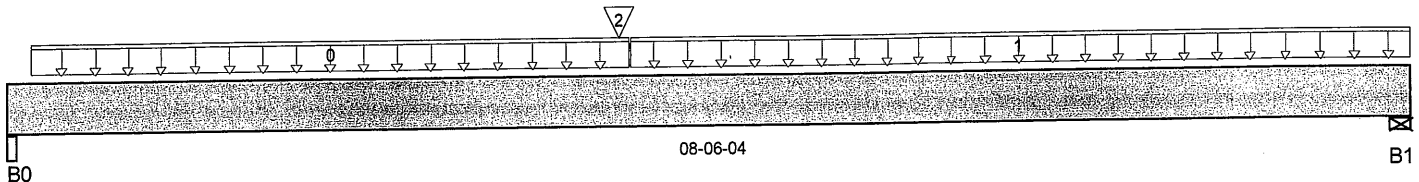

## Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	374 / 0	223 / 0		
B1, 5-1/2"	270 / 0	168 / 0		

## Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-01-12	03-09-04	27	13			n/a
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	03-09-04	08-06-04	6	3			n/a
2	B14(i1269)	Conc. Pt. (lbs)	L	03-08-06	03-08-06	519	288			n/a

## Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	2,511 ft-lbs	12,704 ft-lbs	19.8%	1	03-08-06
End Shear	779 lbs	5,785 lbs	13.5%	1	01-01-00
Total Load Defl.	L/999 (0.065")	n/a	n/a	4	04-00-09
Live Load Defl.	L/999 (0.041")	n/a	n/a	5	04-00-09
Max Defl.	0.065"	n/a	n/a	4	04-00-09
Span / Depth	10	n/a	n/a		00-00-00

## Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Beam	3-1/2" x 1-3/4"	839 lbs	12.6%	11.2%	Unspecified
B1 Wall/Plate	5-1/2" x 1-3/4"	615 lbs	12%	5.2%	Unspecified

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.  
 Design meets Code minimum (L/360) Live load deflection criteria.  
 Calculations assume unbraced length of Top: 00-00-00, Bottom: 00-00-00.  
 Resistance Factor phi has been applied to all presented results per CSA O86.  
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.  
 Design based on Dry Service Condition.  
 Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012



BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



# Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP 1st Floor\...\B13(i1416)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

November 24, 2017 11:04:55

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: EAST GWILLIMBURY,

Customer:

Code reports: CCMC 12472-R

File Name: HOLLAND 9E.mmdl


Description: Designs\Flush Beams\1st Floor\Flush Beams\B13(i1416)

Specifier:

Designer: AJ

Company:

Misc:

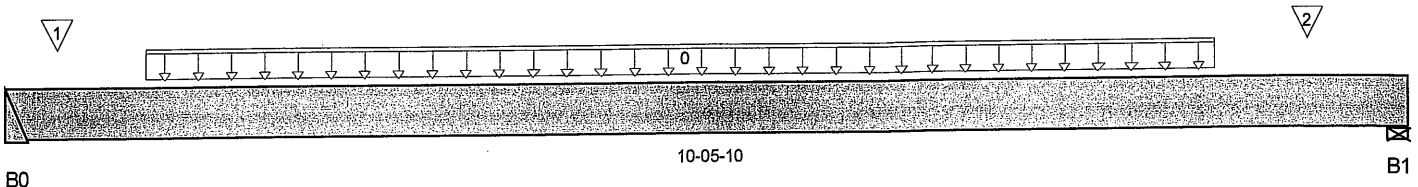

Total Horizontal Product Length = 10-05-10

## Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0	1,833 / 0	966 / 0		
B1, 5-1/2"	1,872 / 0	987 / 0		

## Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	Smoothed Load	Unf. Lin. (lb/ft)	L	01-00-10	09-00-10	358	179			n/a
1	-	Conc. Pt. (lbs)	L	00-04-10	00-04-10	384	192			n/a
2	-	Conc. Pt. (lbs)	L	09-08-10	09-08-10	449	224			n/a

## Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	9,546 ft-lbs	25,408 ft-lbs	37.6%	1	05-08-10
End Shear	3,419 lbs	11,571 lbs	29.5%	1	09-02-10
Total Load Defl.	L/494 (0.242")	0.498"	48.6%	4	05-00-10
Live Load Defl.	L/754 (0.159")	0.332"	47.7%	5	05-00-10
Max Defl.	0.242"	n/a	n/a	4	05-00-10
Span / Depth	12.6	n/a	n/a		00-00-00

## Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Hanger	2" x 3-1/2"	3,958 lbs	n/a	46.3%	HGUS410
B1 Wall/Plate	5-1/2" x 3-1/2"	4,042 lbs	39.3%	17.2%	Unspecified

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume unbraced length of Top: 00-00-00, Bottom: 00-00-00.

Hanger Manufacturer: Unassigned


Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

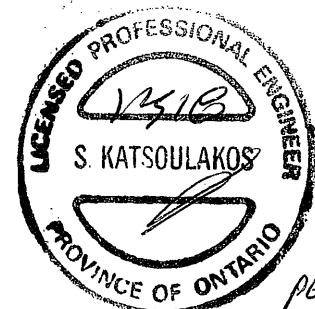



# Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP 1st Floor\...\B13(i1416)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

November 24, 2017 11:04:55

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: EAST GWILLIMBURY,

Customer:

Code reports: CCMC 12472-R

File Name: HOLLAND 9E.mmdl

Description: Designs\Flush Beams\1st Floor\Flush Beams\B13(i1416)


Specifier:

Designer: AJ

Company:

Misc:

## Connection Diagram

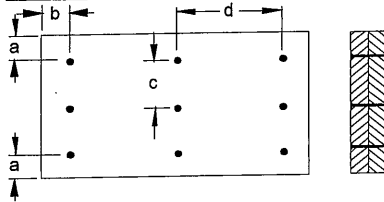

a minimum = 2" c = 2-3/4"  
b minimum = 3" d = 6"

Calculated Side Load = 567.1 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Common Nails

3-1/2" ARDOX SPIRAL

## Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



*Handwritten signature*



# Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP 1st Floor\Flush Beams\B14(i1269)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

November 24, 2017 11:05:02

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: EAST GWILLIMBURY,

Customer:

Code reports: CCMC 12472-R

File Name: HOLLAND 9E.mmdl


Description: Designs\Flush Beams\1st Floor\Flush Beams\B14(i1269)

Specifier:

Designer: AJ

Company:

Misc:

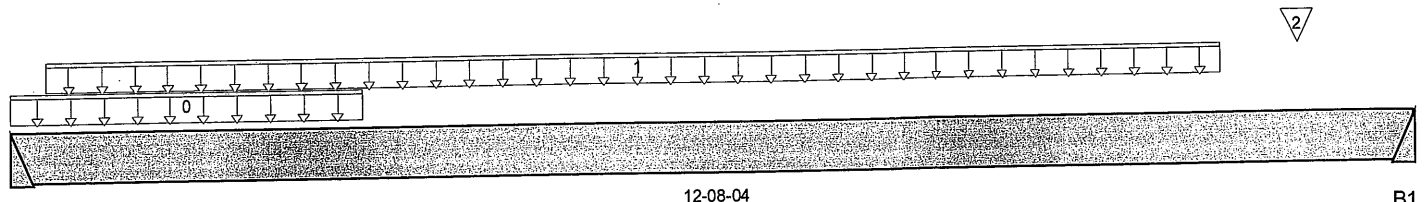

B0

Total Horizontal Product Length = 12-08-04

B1

## Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0	1,107 / 0	582 / 0		
B1	518 / 0	287 / 0		

## Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	STAIR	Unf. Lin. (lb/ft)	L	00-00-00	03-02-04	240	120			n/a
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-03-12	10-11-12	72	36			n/a
2	J4(i1360)	Conc. Pt. (lbs)	L	11-07-12	11-07-12	89	44			n/a

## Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	4,465 ft-lbs	12,704 ft-lbs	35.1%	1	04-11-12
End Shear	1,894 lbs	5,785 lbs	32.7%	1	00-11-08
Total Load Defl.	L/418 (0.358")	0.624"	57.4%	4	06-01-12
Live Load Defl.	L/644 (0.232")	0.416"	55.9%	5	06-01-12
Max Defl.	0.358"	n/a	n/a	4	06-01-12
Span / Depth	15.8	n/a	n/a		00-00-00

## Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

## Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Hanger	2" x 1-3/4"	2,389 lbs	n/a	55.9%	HUS1.81/10
B1 Hanger	2" x 1-3/4"	1,136 lbs	n/a	26.6%	HUS1.81/10

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.



CONFORMS TO OBC 2012

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.







## Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf  
Simple Spans, L/480 Deflection Limit  
5/8" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-2"	13'-9"	N/A	15'-7"	14'-8"	14'-2"	N/A
	NI-40x	16'-1"	15'-2"	14'-8"	N/A	16'-7"	15'-7"	15'-1"	N/A
	NI-60	16'-3"	15'-4"	14'-10"	N/A	16'-8"	15'-9"	15'-3"	N/A
	NI-70	17'-1"	16'-1"	15'-6"	N/A	17'-5"	16'-5"	15'-10"	N/A
	NI-80	17'-3"	16'-3"	15'-8"	N/A	17'-8"	16'-7"	16'-0"	N/A
11-7/8"	NI-20	16'-11"	16'-0"	15'-5"	N/A	17'-6"	16'-6"	16'-0"	N/A
	NI-40x	18'-1"	17'-0"	16'-5"	N/A	18'-9"	17'-6"	16'-11"	N/A
	NI-60	18'-4"	17'-3"	16'-7"	N/A	19'-0"	17'-8"	17'-1"	N/A
	NI-70	19'-6"	18'-0"	17'-4"	N/A	20'-1"	18'-7"	17'-9"	N/A
	NI-80	19'-9"	18'-3"	17'-6"	N/A	20'-4"	18'-10"	17'-11"	N/A
14"	NI-90x	20'-4"	18'-9"	17'-11"	N/A	20'-10"	19'-3"	18'-5"	N/A
	NI-40x	20'-1"	18'-7"	17'-10"	N/A	20'-10"	19'-4"	18'-6"	N/A
	NI-60	20'-5"	18'-11"	18'-1"	N/A	21'-2"	19'-7"	18'-9"	N/A
	NI-70	21'-7"	20'-0"	19'-1"	N/A	22'-3"	20'-7"	19'-8"	N/A
	NI-80	21'-11"	20'-3"	19'-4"	N/A	22'-7"	20'-11"	20'-0"	N/A
16"	NI-90x	22'-7"	20'-11"	19'-11"	N/A	23'-3"	21'-6"	20'-6"	N/A
	NI-60	22'-3"	20'-8"	19'-9"	N/A	23'-1"	21'-5"	20'-6"	N/A
	NI-70	23'-6"	21'-9"	20'-9"	N/A	24'-3"	22'-5"	21'-5"	N/A
	NI-80	23'-11"	22'-1"	21'-1"	N/A	24'-8"	22'-10"	21'-9"	N/A
	NI-90x	24'-8"	22'-9"	21'-9"	N/A	25'-4"	23'-5"	22'-4"	N/A

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-8"	15'-3"	14'-5"	N/A	16'-8"	15'-3"	14'-5"	N/A
	NI-40x	17'-11"	16'-11"	16'-1"	N/A	18'-5"	17'-1"	16'-1"	N/A
	NI-60	18'-2"	17'-1"	16'-4"	N/A	18'-7"	17'-4"	16'-4"	N/A
	NI-70	19'-2"	17'-10"	17'-2"	N/A	19'-7"	18'-3"	17'-7"	N/A
	NI-80	19'-5"	18'-0"	17'-4"	N/A	19'-10"	18'-5"	17'-8"	N/A
11-7/8"	NI-20	19'-6"	18'-1"	17'-3"	N/A	19'-11"	18'-3"	17'-3"	N/A
	NI-40x	21'-0"	19'-6"	18'-8"	N/A	21'-7"	20'-2"	19'-2"	N/A
	NI-60	21'-4"	19'-9"	18'-11"	N/A	21'-11"	20'-4"	19'-6"	N/A
	NI-70	22'-6"	20'-10"	19'-11"	N/A	23'-0"	21'-5"	20'-5"	N/A
	NI-80	22'-9"	21'-1"	20'-1"	N/A	23'-3"	21'-7"	20'-8"	N/A
14"	NI-90x	23'-4"	21'-8"	20'-8"	N/A	23'-10"	22'-2"	21'-2"	N/A
	NI-40x	23'-7"	21'-11"	20'-11"	N/A	24'-3"	22'-7"	21'-7"	N/A
	NI-60	24'-0"	22'-3"	21'-3"	N/A	24'-8"	22'-11"	21'-11"	N/A
	NI-70	25'-3"	23'-4"	22'-3"	N/A	25'-10"	24'-0"	22'-11"	N/A
	NI-80	25'-7"	23'-8"	22'-7"	N/A	26'-2"	24'-4"	23'-2"	N/A
16"	NI-90x	26'-4"	24'-4"	23'-3"	N/A	26'-10"	24'-11"	23'-9"	N/A
	NI-60	26'-5"	24'-6"	23'-4"	N/A	27'-2"	25'-3"	24'-2"	N/A
	NI-70	27'-9"	25'-8"	24'-6"	N/A	28'-5"	26'-5"	25'-2"	N/A
	NI-80	28'-2"	26'-1"	24'-10"	N/A	28'-10"	26'-9"	25'-6"	N/A
	NI-90x	29'-0"	26'-10"	25'-7"	N/A	29'-7"	27'-5"	26'-2"	N/A

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.



## Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf  
Simple Spans, L/480 Deflection Limit  
3/4" OSB G&N Sheathing



Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-10"	15'-0"	14'-5"	13'-5"	16'-4"	15'-5"	14'-6"	13'-5"
	NI-40x	17'-0"	16'-0"	15'-5"	14'-9"	17'-5"	16'-5"	15'-10"	15'-2"
	NI-60	17'-2"	16'-2"	15'-7"	14'-11"	17'-6"	16'-7"	15'-11"	15'-3"
	NI-70	18'-0"	16'-11"	16'-3"	15'-7"	18'-5"	17'-3"	16'-7"	15'-11"
	NI-80	18'-3"	17'-1"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	16'-1"
11-7/8"	NI-20	17'-10"	16'-10"	16'-2"	15'-6"	18'-6"	17'-4"	16'-9"	16'-1"
	NI-40x	19'-4"	17'-11"	17'-3"	16'-6"	19'-11"	18'-6"	17'-9"	17'-0"
	NI-60	19'-7"	18'-2"	17'-5"	16'-9"	20'-2"	18'-9"	17'-11"	17'-2"
	NI-70	20'-9"	19'-2"	18'-3"	17'-5"	21'-4"	19'-9"	18'-10"	17'-10"
	NI-80	21'-1"	19'-5"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
14"	NI-90x	21'-8"	20'-0"	19'-1"	18'-0"	22'-2"	20'-6"	19'-6"	18'-6"
	NI-40x	21'-5"	19'-10"	18'-11"	17'-11"	22'-1"	20'-6"	19'-7"	18'-7"
	NI-60	21'-10"	20'-2"	19'-3"	18'-2"	22'-5"	20'-10"	19'-11"	18'-10"
	NI-70	23'-0"	21'-3"	20'-3"	19'-2"	23'-8"	21'-11"	20'-10"	19'-9"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
16"	NI-90x	24'-1"	22'-3"	21'-2"	20'-0"	24'-8"	22'-10"	21'-9"	20'-7"
	NI-60	23'-9"	22'-0"	20'-11"	19'-10"	24'-6"	22'-9"	21'-8"	20'-6"
	NI-70	25'-1"	23'-2"	22'-0"	20'-10"	25'-9"	23'-10"	22'-9"	21'-6"
	NI-80	25'-6"	23'-6"	22'-4"	21'-2"	26'-1"	24'-2"	23'-1"	21'-10"
	NI-90x	26'-4"	24'-3"	23'-1"	21'-10"	26'-11"	24'-11"	23'-8"	22'-5"

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-10"	15'-5"	14'-6"	13'-5"	16'-10"	15'-5"	14'-6"	13'-5"
	NI-40x	18'-8"	17'-2"	16'-3"	15'-2"	18'-10"	17'-2"	16'-3"	15'-2"
	NI-60	18'-11"	17'-6"	16'-6"	15'-5"	19'-2"	17'-6"	16'-6"	15'-5"
	NI-70	20'-0"	18'-7"	17'-9"	16'-7"	20'-5"	18'-11"	17'-10"	16'-7"
	NI-80	20'-3"	18'-10"	17'-11"	16'-10"	20'-8"	19'-3"	18'-2"	16'-10"
11-7/8"	NI-20	20'-1"	18'-5"	17'-5"	16'-2"	20'-1"	18'-5"	17'-5"	16'-2"
	NI-40x	21'-10"	20'-4"	19'-4"	17'-8"	22'-5"	20'-6"	19'-4"	17'-8"
	NI-60	22'-1"	20'-7"	19'-7"	18'-4"	22'-8"	20'-10"	19'-8"	18'-4"
	NI-70	23'-4"	21'-8"	20'-8"	19'-7"	23'-10"	22'-3"	21'-2"	19'-9"
	NI-80	23'-7"	21'-11"	20'-11"	19'-9"	24'-1"	22'-6"	21'-5"	20'-0"
14"	NI-90x	24'-3"	22'-6"	21'-6"	20'-4"	24'-8"	23'-0"	22'-0"	20'-9"
	NI-40x	24'-5"	22'-9"	21'-8"	19'-5"	25'-1"	23'-2"	21'-9"	19'-5"
	NI-60	24'-10"	23'-1"	22'-0"	20'-10"	25'-6"	23'-8"	22'-4"	20'-10"
	NI-70	26'-1"	24'-3"	23'-2"	21'-10"	26'-8"	24'-11"	23'-9"	22'-4"
	NI-80	26'-6"	24'-7"	23'-5"	22'-2"	27'-1"	25'-3"	24'-1"	22'-9"
16"	NI-90x	27'-3"	25'-4"	24'-1"	22'-9"	27'-9"	25'-11"	24'-8"	23'-4"
	NI-60	27'-3"	25'-5"	24'-2"	22'-10"	28'-0"	26'-2"	24'-9"	23'-1"
	NI-70	28'-8"	26'-8"	25'-4"	23'-11"	29'-3"	27'-4"	26'-1"	24'-8"
	NI-80	29'-1"	27'-0"	25'-9"	24'-4"	29'-8"	27'-9"	26'-5"	25'-0"
	NI-90x	29'-11"	27'-10"	26'-6"	25'-0"	30'-6"	28'-5"	27'-2"	25'-8"

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.





## Maximum Floor Spans



Live Load = 40 psf, Dead Load = 30 psf  
Simple Spans, L/480 Deflection Limit  
5/8" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-1"	13'-3"	N/A	15'-7"	14'-1"	13'-3"	N/A
	NI-40x	16'-1"	15'-2"	14'-8"	N/A	16'-7"	15'-7"	15'-1"	N/A
	NI-60	16'-3"	15'-4"	14'-10"	N/A	16'-8"	15'-9"	15'-3"	N/A
	NI-70	17'-1"	16'-1"	15'-6"	N/A	17'-5"	16'-5"	15'-10"	N/A
	NI-80	17'-3"	16'-3"	15'-8"	N/A	17'-8"	16'-7"	16'-0"	N/A
11-7/8"	NI-20	16'-11"	16'-0"	15'-5"	N/A	17'-6"	16'-6"	16'-0"	N/A
	NI-40x	18'-1"	17'-0"	16'-5"	N/A	18'-9"	17'-6"	16'-11"	N/A
	NI-60	18'-4"	17'-3"	16'-7"	N/A	19'-0"	17'-8"	17'-1"	N/A
	NI-70	19'-6"	18'-0"	17'-4"	N/A	20'-1"	18'-7"	17'-9"	N/A
	NI-80	19'-9"	18'-3"	17'-6"	N/A	20'-4"	18'-10"	17'-11"	N/A
14"	NI-90x	20'-4"	18'-9"	17'-11"	N/A	20'-10"	19'-3"	18'-5"	N/A
	NI-40x	20'-1"	18'-7"	17'-10"	N/A	20'-10"	19'-4"	18'-6"	N/A
	NI-60	20'-5"	18'-11"	18'-1"	N/A	21'-2"	19'-7"	18'-9"	N/A
	NI-70	21'-7"	20'-0"	19'-1"	N/A	22'-3"	20'-7"	19'-8"	N/A
	NI-80	21'-11"	20'-3"	19'-4"	N/A	22'-7"	20'-11"	20'-0"	N/A
16"	NI-90x	22'-7"	20'-11"	19'-11"	N/A	23'-3"	21'-6"	20'-6"	N/A
	NI-60	22'-3"	20'-8"	19'-9"	N/A	23'-1"	21'-5"	20'-6"	N/A
	NI-70	23'-6"	21'-9"	20'-9"	N/A	24'-3"	22'-5"	21'-5"	N/A
	NI-80	23'-11"	22'-1"	21'-1"	N/A	24'-8"	22'-10"	21'-9"	N/A
	NI-90x	24'-8"	22'-9"	21'-9"	N/A	25'-4"	23'-5"	22'-4"	N/A

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-1"	13'-3"	N/A	15'-7"	14'-1"	13'-3"	N/A
	NI-40x	17'-9"	16'-1"	15'-1"	N/A	17'-9"	16'-1"	15'-1"	N/A
	NI-60	18'-1"	16'-4"	15'-4"	N/A	18'-1"	16'-4"	15'-4"	N/A
	NI-70	19'-2"	17'-10"	16'-9"	N/A	19'-7"	17'-10"	16'-9"	N/A
	NI-80	19'-5"	18'-0"	17'-1"	N/A	19'-10"	18'-3"	17'-1"	N/A
11-7/8"	NI-20	18'-9"	17'-0"	16'-0"	N/A	18'-9"	17'-0"	16'-0"	N/A
	NI-40x	21'-0"	19'-3"	17'-9"	N/A	21'-3"	19'-3"	17'-9"	N/A
	NI-60	21'-4"	19'-8"	18'-5"	N/A	21'-8"	19'-8"	18'-5"	N/A
	NI-70	22'-6"	20'-10"	19'-11"	N/A	23'-0"	21'-4"	20'-0"	N/A
	NI-80	22'-9"	21'-1"	20'-1"	N/A	23'-3"	21'-7"	20'-5"	N/A
14"	NI-90x	23'-4"	21'-8"	20'-8"	N/A	23'-10"	22'-2"	21'-2"	N/A
	NI-40x	23'-7"	21'-5"	19'-6"	N/A	24'-1"	21'-5"	19'-6"	N/A
	NI-60	24'-0"	22'-3"	21'-0"	N/A	24'-8"	22'-5"	21'-0"	N/A
	NI-70	25'-3"	23'-4"	22'-3"	N/A	25'-10"	24'-0"	22'-9"	N/A
	NI-80	25'-7"	23'-8"	22'-7"	N/A	26'-2"	24'-4"	23'-2"	N/A
16"	NI-90x	26'-4"	24'-4"	23'-3"	N/A	26'-10"	24'-11"	23'-9"	N/A
	NI-60	26'-5"	24'-6"	23'-4"	N/A	27'-2"	24'-10"	23'-4"	N/A
	NI-70	27'-9"	25'-8"	24'-6"	N/A	28'-5"	26'-5"	25'-2"	N/A
	NI-80	28'-2"	26'-1"	24'-10"	N/A	28'-10"	26'-9"	25'-6"	N/A
	NI-90x	29'-0"	26'-10"	25'-7"	N/A	29'-7"	27'-5"	26'-2"	N/A

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.



## Maximum Floor Spans

Live Load = 40 psf, Dead Load = 30 psf  
Simple Spans, L/480 Deflection Limit  
3/4" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-2"	13'-4"	12'-4"	15'-7"	14'-2"	13'-4"	12'-4"
	NI-40x	17'-0"	16'-0"	15'-1"	13'-11"	17'-5"	16'-1"	15'-1"	13'-11"
	NI-60	17'-2"	16'-2"	15'-5"	14'-3"	17'-6"	16'-5"	15'-5"	14'-3"
	NI-70	18'-0"	16'-11"	16'-3"	15'-6"	18'-5"	17'-3"	16'-7"	15'-6"
	NI-80	18'-3"	17'-1"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	15'-10"
11-7/8"	NI-20	17'-10"	16'-10"	16'-0"	14'-10"	18'-6"	17'-1"	16'-0"	14'-10"
	NI-40x	19'-4"	17'-11"	17'-3"	15'-10"	19'-11"	18'-6"	17'-9"	15'-10"
	NI-60	19'-7"	18'-2"	17'-5"	16'-9"	20'-2"	18'-9"	17'-11"	17'-1"
	NI-70	20'-9"	19'-2"	18'-3"	17'-5"	21'-4"	19'-9"	18'-10"	17'-10"
	NI-80	21'-1"	19'-5"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
	NI-90x	21'-8"	20'-0"	19'-1"	18'-0"	22'-2"	20'-6"	19'-6"	18'-6"
14"	NI-40x	21'-5"	19'-10"	18'-11"	17'-5"	22'-1"	20'-6"	19'-6"	17'-5"
	NI-60	21'-10"	20'-2"	19'-3"	18'-2"	22'-5"	20'-10"	19'-11"	18'-10"
	NI-70	23'-0"	21'-3"	20'-3"	19'-2"	23'-8"	21'-11"	20'-10"	19'-9"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
	NI-90x	24'-1"	22'-3"	21'-2"	20'-0"	24'-8"	22'-10"	21'-9"	20'-7"
16"	NI-60	23'-9"	22'-0"	20'-11"	19'-10"	24'-6"	22'-9"	21'-8"	20'-6"
	NI-70	25'-1"	23'-2"	22'-0"	20'-10"	25'-9"	23'-10"	22'-9"	21'-6"
	NI-80	25'-6"	23'-6"	22'-4"	21'-2"	26'-1"	24'-2"	23'-1"	21'-10"
	NI-90x	26'-4"	24'-3"	23'-1"	21'-10"	26'-11"	24'-11"	23'-8"	22'-5"


  

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-2"	13'-4"	12'-4"	15'-7"	14'-2"	13'-4"	12'-4"
	NI-40x	17'-9"	16'-1"	15'-1"	13'-11"	17'-9"	16'-1"	15'-1"	13'-11"
	NI-60	18'-1"	16'-5"	15'-5"	14'-3"	18'-1"	16'-5"	15'-5"	14'-3"
	NI-70	19'-10"	17'-11"	16'-9"	15'-6"	19'-10"	17'-11"	16'-9"	15'-6"
	NI-80	20'-2"	18'-3"	17'-1"	15'-10"	20'-2"	18'-3"	17'-1"	15'-10"
11-7/8"	NI-20	18'-10"	17'-1"	16'-0"	14'-10"	18'-10"	17'-1"	16'-0"	14'-10"
	NI-40x	21'-3"	19'-3"	17'-9"	15'-10"	21'-3"	19'-3"	17'-9"	15'-10"
	NI-60	21'-9"	19'-8"	18'-5"	17'-1"	21'-9"	19'-8"	18'-5"	17'-1"
	NI-70	23'-4"	21'-5"	20'-1"	18'-6"	23'-8"	21'-5"	20'-1"	18'-6"
	NI-80	23'-7"	21'-10"	20'-5"	18'-11"	24'-1"	21'-10"	20'-5"	18'-11"
	NI-90x	24'-3"	22'-6"	21'-3"	19'-7"	24'-8"	22'-7"	21'-3"	19'-7"
14"	NI-40x	24'-2"	21'-5"	19'-6"	17'-5"	24'-2"	21'-5"	19'-6"	17'-5"
	NI-60	24'-9"	22'-5"	21'-0"	19'-6"	24'-9"	22'-5"	21'-0"	19'-6"
	NI-70	26'-1"	24'-3"	22'-9"	21'-0"	26'-8"	24'-3"	22'-9"	21'-0"
	NI-80	26'-6"	24'-7"	23'-3"	21'-6"	27'-1"	24'-10"	23'-3"	21'-6"
	NI-90x	27'-3"	25'-4"	24'-1"	22'-4"	27'-9"	25'-10"	24'-3"	22'-4"
16"	NI-60	27'-3"	24'-11"	23'-5"	21'-7"	27'-6"	24'-11"	23'-5"	21'-7"
	NI-70	28'-8"	26'-8"	25'-3"	23'-4"	29'-3"	26'-11"	25'-3"	23'-4"
	NI-80	29'-1"	27'-0"	25'-9"	23'-10"	29'-8"	27'-6"	25'-10"	23'-10"
	NI-90x	29'-11"	27'-10"	26'-6"	24'-10"	30'-6"	28'-5"	26'-11"	24'-10"

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.




# INSTALLATION GUIDE FOR RESIDENTIAL FLOORS

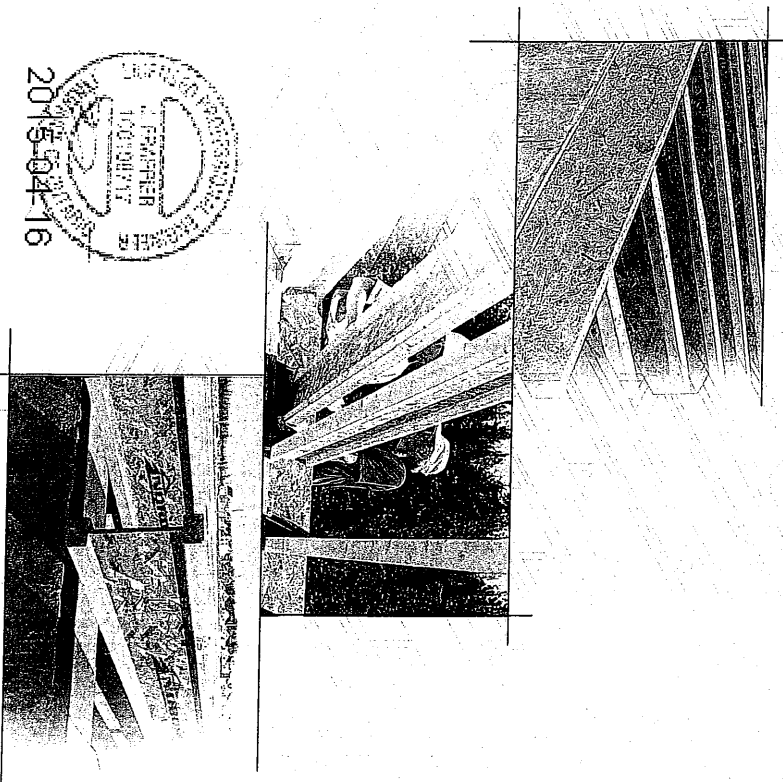

2015-04-16

Distributed by:



N-C301 / November 2014

## SAFETY AND CONSTRUCTION PRECAUTIONS

### WARNING

I-joists are not stable until completely installed, and will not carry any load until fully braced and sheathed.

#### Avoid Accidents by Following these Important Guidelines:

1. Brace and nail each I-joist as it is installed, using hangers, blocking panels, rim board, and/or cross-bridging at joist ends. When I-joists are applied continuous over interior supports and a load-bearing wall is planned at that location, blocking will be required at the interior support.
2. When the building is completed, the floor sheathing will provide lateral support for the top flanges of the I-joists. Until this sheathing is applied, temporary bracing, often called struts, or temporary sheathing must be applied to prevent I-joist rollover or buckling.
  - Temporary bracing or struts must be 1x4 inch minimum, at least 8 feet long and spaced no more than 8 feet on center, and must be secured with a minimum of two 2-1/2" nails fastened to the top surface of each I-joist. Nail the bracing to a lateral restraint at the end of each bay. Lap ends of adjoining bracing over at least two I-joists.
  - Or, sheathing (temporary or permanent) can be nailed to the top flange of the first 4 feet of I-joists at the end of the bay.
3. For cantilevered I-joists, brace top and bottom flanges, and brace ends with closure panels, rim board, or cross-bridging.
4. Install and fully nail permanent sheathing to each I-joist before placing loads on the floor system. Then, stack building materials over beams or walls only.
5. Never install a damaged I-joist.



Do not walk on I-joists until fully fastened and braced, or serious injuries can result.




Never stack building materials over unsheathed I-joists. Once sheathed, do not over-stress I-joist with concentrated loads from building materials.

Improper storage or installation, failure to follow applicable building codes, failure to follow span ratings for Nordic I-joists, failure to follow allowable hole sizes and locations, or failure to use web stiffeners when required can result in serious accidents. Follow these installation guidelines carefully.

## STORAGE AND HANDLING GUIDELINES

1. Bundle wrap can be slippery when wet. Avoid walking on wrapped bundles.
2. Store, stack, and handle I-joists vertically and level only.
3. Always stack and handle I-joists in the upright position only.
4. Do not store I-joists in direct contact with the ground and/or flatwise.
5. Protect I-joists from weather, and use spacers to separate bundles.
6. Bundled units should be kept intact until time of installation.
7. When handling I-joists with a crane on the job site, take a few simple precautions to prevent damage to the I-joists and injury to your work crew.
  - Pick I-joists in bundles as shipped by the supplier.
  - Orient the bundles so that the webs of the I-joists are vertical.
  - Pick the bundles at the 5th points, using a spreader bar if necessary.
8. Do not handle I-joists in a horizontal orientation.
9. NEVER USE OR TRY TO REPAIR A DAMAGED I-JOIST.



## MAXIMUM FLOOR SPANS

1. Maximum clear spans applicable to simple-span or multiple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration and a live load deflection limit of L/480. For multiple-span applications, the end spans shall be 40% or more of the adjacent span.
2. Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less, or 3/4 inch for joist spacing of 24 inches. Adhesive shall meet the requirements given in CGS-71.26 Standard. No concrete topping or bridging element was assumed. Increased spans may be achieved with the use of gypsum and/or a row of blocking at mid-span.
3. Minimum bearing length shall be 1-3/4 inches for the end bearings, and 3-1/2 inches for the intermediate bearings.
4. Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
5. This span chart is based on uniform loads. For applications with other than uniform loads, an engineering analysis may be required based on the use of the design properties.
6. Tables are based on Limit States Design per CAN/CSA O86-09 Standard, and NBC 2010.
7. SI units conversion: 1 inch = 25.4 mm  
1 foot = 0.305 m

## MAXIMUM FLOOR SPANS FOR NORDIC I-JOISTS SIMPLE AND MULTIPLE SPANS

Joist Depth	Joist Series	Simple spans On centre spacing				Multiple spans On centre spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
12"	NI-20	15.1	14.2	13.9	13.5	16.3	15.4	15.0	14.7
12"	NI-24	16.1	15.2	14.9	14.5	17.3	16.4	16.0	15.7
12"	NI-28	17.1	16.2	15.9	15.5	18.3	17.4	17.0	16.7
12"	NI-32	18.1	17.2	16.9	16.5	19.3	18.4	18.0	17.7
12"	NI-36	19.1	18.2	17.9	17.5	20.3	19.4	19.0	18.7
12"	NI-40	20.1	19.2	18.9	18.5	21.3	20.4	20.0	19.7
12"	NI-44	21.1	20.2	19.9	19.5	22.3	21.4	21.0	20.7
12"	NI-48	22.1	21.2	20.9	20.5	23.3	22.4	22.0	21.7
12"	NI-52	23.1	22.2	21.9	21.5	24.3	23.4	23.0	22.7
12"	NI-56	24.1	23.2	22.9	22.5	25.3	24.4	24.0	23.7
12"	NI-60	25.1	24.2	23.9	23.5	26.3	25.4	25.0	24.7
16"	NI-20	18.1	17.2	16.9	16.5	19.3	18.4	18.0	17.7
16"	NI-24	19.1	18.2	17.9	17.5	20.3	19.4	19.0	18.7
16"	NI-28	20.1	19.2	18.9	18.5	21.3	20.4	20.0	19.7
16"	NI-32	21.1	20.2	19.9	19.5	22.3	21.4	21.0	20.7
16"	NI-36	22.1	21.2	20.9	20.5	23.3	22.4	22.0	21.7
16"	NI-40	23.1	22.2	21.9	21.5	24.3	23.4	23.0	22.7
16"	NI-44	24.1	23.2	22.9	22.5	25.3	24.4	24.0	23.7
16"	NI-48	25.1	24.2	23.9	23.5	26.3	25.4	25.0	24.7
16"	NI-52	26.1	25.2	24.9	24.5	27.3	26.4	26.0	25.7
16"	NI-56	27.1	26.2	25.9	25.5	28.3	27.4	27.0	26.7
16"	NI-60	28.1	27.2	26.9	26.5	29.3	28.4	28.0	27.7
19.2"	NI-20	20.1	19.2	18.9	18.5	21.3	20.4	20.0	19.7
19.2"	NI-24	21.1	20.2	19.9	19.5	22.3	21.4	21.0	20.7
19.2"	NI-28	22.1	21.2	20.9	20.5	23.3	22.4	22.0	21.7
19.2"	NI-32	23.1	22.2	21.9	21.5	24.3	23.4	23.0	22.7
19.2"	NI-36	24.1	23.2	22.9	22.5	25.3	24.4	24.0	23.7
19.2"	NI-40	25.1	24.2	23.9	23.5	26.3	25.4	25.0	24.7
19.2"	NI-44	26.1	25.2	24.9	24.5	27.3	26.4	26.0	25.7
19.2"	NI-48	27.1	26.2	25.9	25.5	28.3	27.4	27.0	26.7
19.2"	NI-52	28.1	27.2	26.9	26.5	29.3	28.4	28.0	27.7
19.2"	NI-56	29.1	28.2	27.9	27.5	30.3	29.4	29.0	28.7
19.2"	NI-60	30.1	29.2	28.9	28.5	31.3	30.4	30.0	29.7
24"	NI-20	15.1	14.2	13.9	13.5	16.3	15.4	15.0	14.7
24"	NI-24	16.1	15.2	14.9	14.5	17.3	16.4	16.0	15.7
24"	NI-28	17.1	16.2	15.9	15.5	18.3	17.4	17.0	16.7
24"	NI-32	18.1	17.2	16.9	16.5	19.3	18.4	18.0	17.7
24"	NI-36	19.1	18.2	17.9	17.5	20.3	19.4	19.0	18.7
24"	NI-40	20.1	19.2	18.9	18.5	21.3	20.4	20.0	19.7
24"	NI-44	21.1	20.2	19.9	19.5	22.3	21.4	21.0	20.7
24"	NI-48	22.1	21.2	20.9	20.5	23.3	22.4	22.0	21.7
24"	NI-52	23.1	22.2	21.9	21.5	24.3	23.4	23.0	22.7
24"	NI-56	24.1	23.2	22.9	22.5	25.3	24.4	24.0	23.7
24"	NI-60	25.1	24.2	23.9	23.5	26.3	25.4	25.0	24.7

CMC EVALUATION REPORT 13032-R


## WEB STIFFENERS

### RECOMMENDATIONS:

- A bearing stiffener is required in all engineered applications with factored reactions greater than shown in the I-joist properties table found in the Construction Guide [C101]. The gap between the stiffener and the flange is at the top.
- A bearing stiffener is required when the I-joist is supported in a hanger and the sides of the hanger do not extend up to, and support, the top flange. The gap between the stiffener and flange is at the top.
- A load stiffener is required at locations where a factored concentrated load greater than 2,370 lbs is applied to the top flange between supports, or in the case of a cantilever, anywhere between the cantilever tip and the support. These values are for standard term load duration, and may be adjusted for other load durations as permitted by the code. The gap between the stiffener and the flange is at the bottom.

SI units conversion: 1 inch = 25.4 mm

FIGURE 2  
WEB STIFFENER INSTALLATION DETAILS

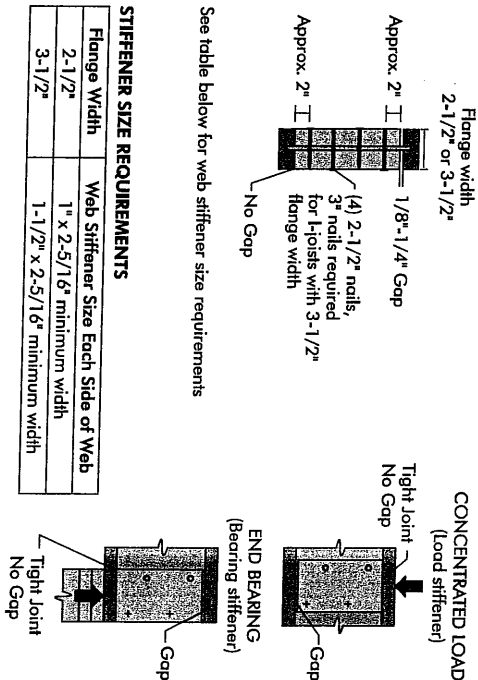

### STIFFENER SIZE REQUIREMENTS

Flange Width	Web Stiffener Size Each Side of Web
2-1/2"	1" x 2-5/16" minimum width
3-1/2"	1-1/2" x 2-5/16" minimum width

## NORDIC I-JOIST SERIES


S-PF No.2	1950F MSR	2100F MSR	1950F MSR	2100F MSR	2400F MSR	NFC Lumber
NI-20	33 pieces per unit	33 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit
NI-24	33 pieces per unit	33 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit
NI-28	33 pieces per unit	33 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit
NI-32	33 pieces per unit	33 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit
NI-36	33 pieces per unit	33 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit
NI-40	33 pieces per unit	33 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit
NI-44	33 pieces per unit	33 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit
NI-48	33 pieces per unit	33 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit
NI-52	33 pieces per unit	33 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit
NI-56	33 pieces per unit	33 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit
NI-60	33 pieces per unit	33 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit

Chantiers Chibougamau Ltd. harvests its own trees, which enables Nordic products to adhere to strict quality control procedures throughout the manufacturing process. Every phase of the operation, from forest to the finished product, reflects our commitment to quality.

Nordic Engineered Wood I-joists use only finger-jointed pick spruce lumber in their flanges, ensuring consistent quality, superior strength, and longer span carrying capacity.

## I-JOIST HANGERS

1. Hangers shown illustrate the three most commonly used metal hangers to support I-joists.
2. All nailing must meet the hanger manufacturer's recommendations.
3. Hangers should be selected based on the joist depth, flange width and load capacity based on the maximum spans.
4. Web stiffeners are required when the sides of the hangers do not laterally brace the top flange of the I-joist.

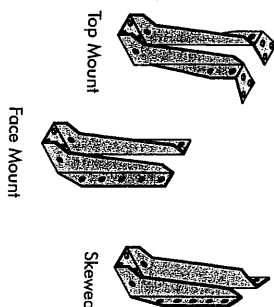

2015-04-16


INSTALLING NORDIC I-JOISTS

1. Before laying out floor system components, verify that I-joist flange widths match hanger widths. If not, contact your supplier.
2. Except for cutting to length, I-joist flanges should **never** be cut, drilled, or notched.
3. Install I-joists so that top and bottom flanges are within 1/2 inch of true vertical alignment.
4. I-joists must be anchored securely to supports before floor sheathing is attached, and supports for multiple-span joists must be level.
5. Minimum bearing lengths: 1-3/4 inches for end bearings and 3-1/2 inches for intermediate bearings.
6. When using hangers, seat I-joists firmly in hanger bottoms to minimize settlement.
7. Leave a 1/16-inch gap between the I-joist end and a header.
8. Concentrated loads greater than those that can normally be expected in residential construction should only be applied to the top surface of the top flange. Normal concentrated loads include track lighting fixtures, audio equipment and security cameras. Never suspend unusual or heavy loads from the I-joist's bottom flange. Whenever possible, suspend all concentrated loads from the top of the I-joist. Or, attach the load to blocking that has been securely fastened to the I-joist webs.
9. Never install I-joists where they will be permanently exposed to weather, or where they will remain in direct contact with concrete or masonry.
10. Restrain ends of floor joists to prevent rollover. Use rim board, rim joists or I-joist blocking panels.
11. For I-joists installed over and beneath bearing walls, use full depth blocking panels, rim board, or squash blocks (cripple members) to transfer gravity loads through the floor system to the wall or foundation below.
12. Due to shrinkage, common framing lumber set on edge **may never** be used as blocking or rim boards. I-joist blocking panels or other engineered wood products – such as rim board – must be cut to fit between the I-joists, and an I-joist-compatible depth selected.
13. Provide permanent lateral support of the bottom flange of all I-joists at interior supports of multiple-span joists. Similarly, support the bottom flange of all cantilevered I-joists of the end support next to the cantilever extension. In the completed structure, the gypsum wallboard ceiling provides this lateral support. Until the final finished ceiling is applied, temporary bracing or struts must be used.
14. If square-edge panels are used, edges must be supported between I-joists with 2x4 blocking. Glue panels to blocking to minimize squeaks. Blocking is not required under structural finish flooring, such as wood strip flooring, or if a separate underlayment layer is installed.
15. Nail spacing: Space nails installed to the flange's top face in accordance with the applicable building code requirements or approved building plans.


2015-04-16

FIGURE 1  
TYPICAL NORDIC I-JOIST FLOOR FRAMING AND CONSTRUCTION DETAILS

Some framing requirements such as erection bracing and blocking panels have been omitted for clarity.

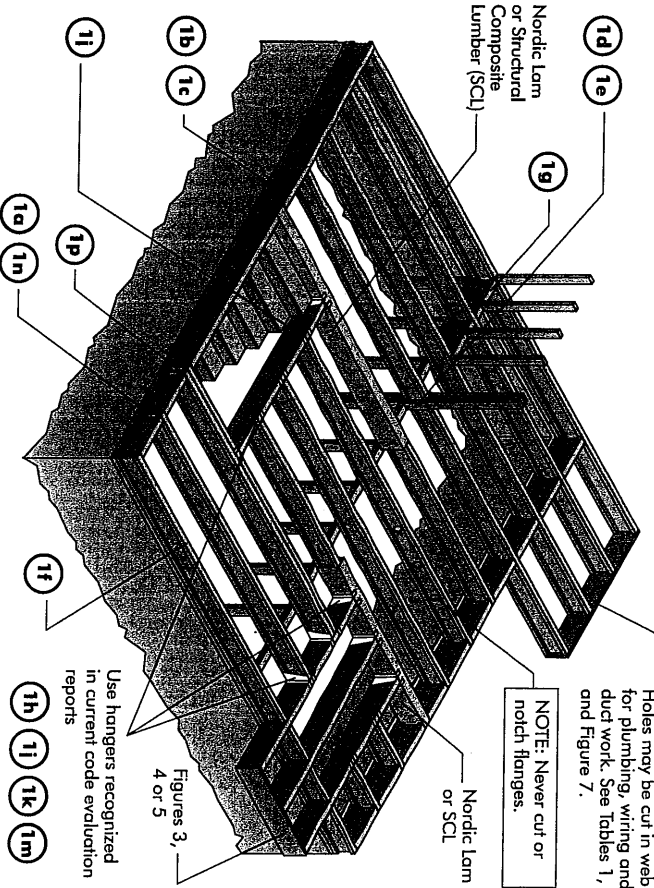


All nails shown in the above details are assumed to be common wire nails unless otherwise noted. 3" (0.122" dia.) common spiral nails may be substituted for 2-1/2" (0.128" dia.) common wire nails. Framing lumber assumed to be Spruce-Pine-Fir No. 2 or better. Individual components not shown to scale for clarity.

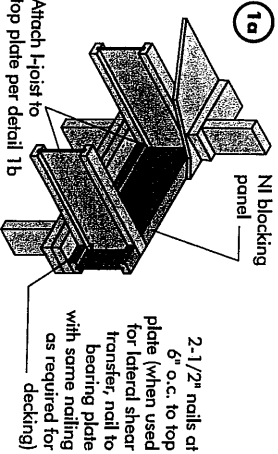


Blocking Panel or Rim Joist	Maximum Factored Uniform Vertical Load* (plf)
Nl Joists	3,300

\*The uniform vertical load is limited to a joist depth of 16 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

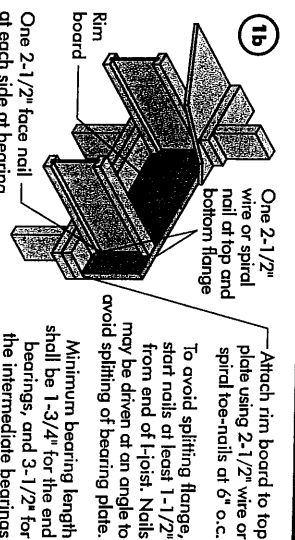


Blocking Panel or Rim Joist	Maximum Factored Uniform Vertical Load* (plf)
1-1/8" Rim Board Plus	8,090

\*The uniform vertical load is limited to a rim board depth of 16 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

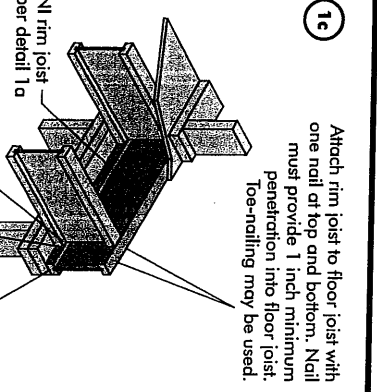









Blocking Panel or Rim Joist	Maximum Factored Uniform Vertical Load* (plf)
Nl rim joist per detail 1a	3,300

\*The uniform vertical load is limited to a rim joist depth of 16 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

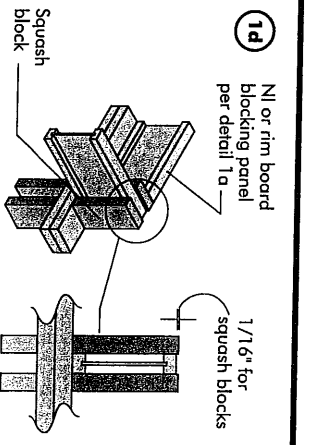

Pair of Squash Blocks	Maximum Factored Vertical per Pair of Squash Blocks (lbs)
2x lumber	5,500
1-1/8" Rim Board Plus	4,300

Provide lateral bracing per detail 1a, 1b, or 1c

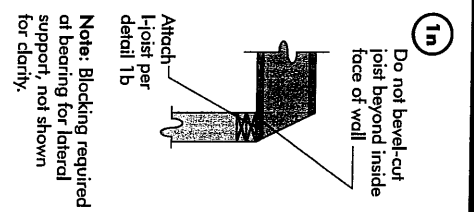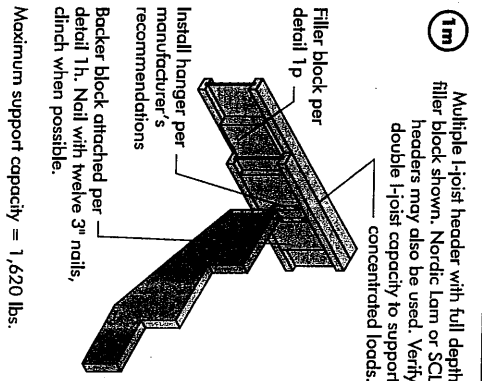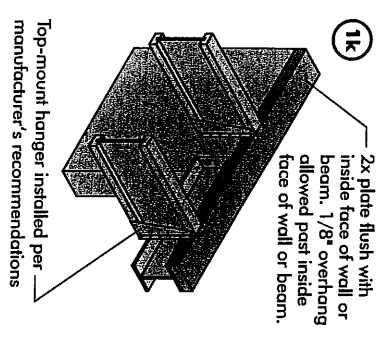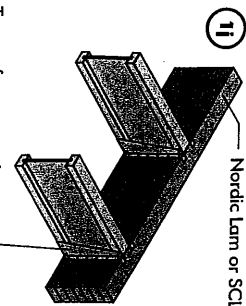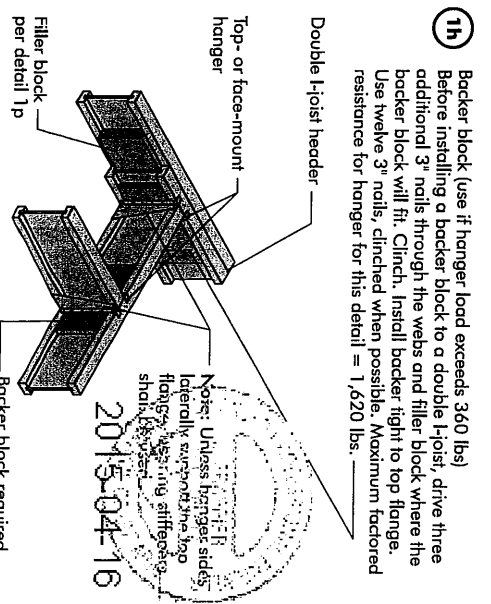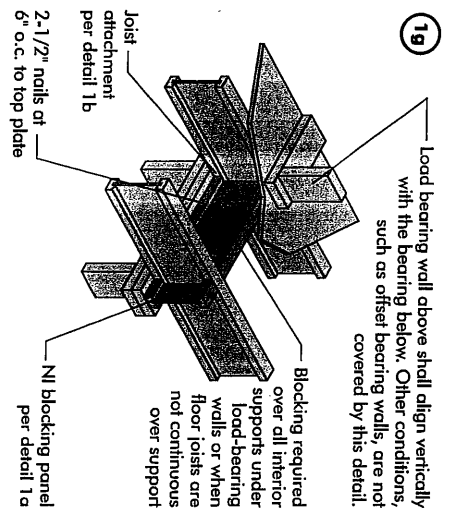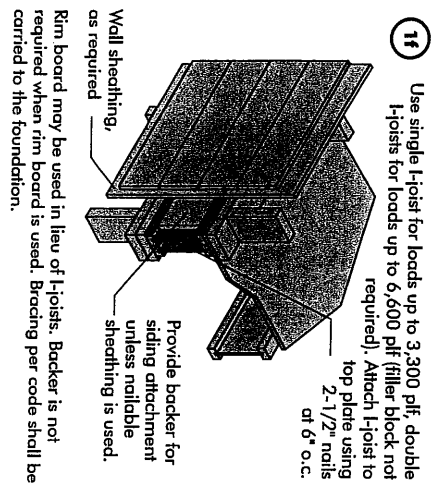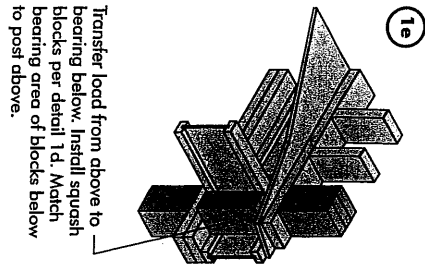

**BACKER BLOCKS** (Blocks must be long enough to permit required nailing without splitting)

Flange Width	Material Thickness Required†	Minimum Depth**
2-1/2"	1"	5-1/2"
3-1/2"	1-1/2"	7-1/4"

\* Minimum grade for backer block material shall be S-P-F No. 2 or better for solid sawn lumber and wood structural panels conforming to CAN/CSA-O325 or CAN/CSA-Q437 Standard.

\*\* For face-mount hangers use net joist depth minus 3-1/4" for joists with 1-1/2" thick flanges. For 2" thick flanges use net depth minus 4-1/4".

For nailing schedules for multiple beams, see the manufacturer's recommendations.

Note: Unless hanger sides laterally support the top flange, bearing stiffeners shall be used.

Top-mount hanger installed per manufacturer's recommendations

Note: Unless hanger sides laterally support the top flange, bearing stiffeners shall be used.

Filler block per detail 1p


Install hanger per manufacturer's recommendations

Backer block attached per detail 1h. Nail with twelve 3" nails, clinch when possible.

Maximum support capacity = 1,620 lbs.

Note: Blocking required at bearing for lateral support, not shown for clarity.

**1p**

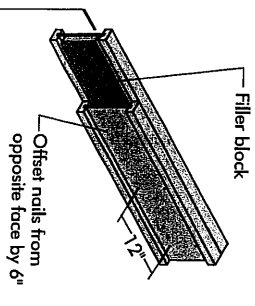


- Notes:**
- Support back of I-joist web during nailing to prevent damage to web/flange connection.
  - Leave a 1/8 to 1/4-inch gap between top of filler block and bottom of top I-joist flange.
  - Filler block is required between joists for full length of span.
  - Nail joists together with two rows of 3" nails at 12 inches o.c. (clinched when possible) on each side of the double I-joist. Total of four nails per foot required. If nails can be clinched, only two nails per foot are required.
  - The maximum factored load that may be applied to one side of the double joist using this detail is 860 lb/ft. Verify double I-joist capacity.

**FILLER BLOCK REQUIREMENTS FOR DOUBLE I-JOIST CONSTRUCTION**


Flange Size	Joist Depth	Filler Block Size
2-1/2" x 1-1/2"	9-1/2"	2-1/8" x 6"
2-1/2" x 1-1/2"	11-7/8"	2-1/8" x 8"
3-1/2" x 1-1/2"	14"	2-1/8" x 10"
3-1/2" x 1-1/2"	16"	2-1/8" x 12"
3-1/2" x 2"	9-1/2"	3" x 6"
3-1/2" x 2"	11-7/8"	3" x 8"
3-1/2" x 2"	14"	3" x 10"
3-1/2" x 2"	16"	3" x 12"
3-1/2" x 2"	11-7/8"	3" x 7"
3-1/2" x 2"	14"	3" x 9"
3-1/2" x 2"	16"	3" x 11"

**1r**

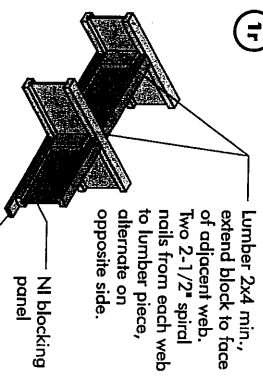

Optional: Minimum 1x4 inch strap applied to underside of joist at blocking line or 1/2 inch minimum gypsum ceiling attached to underside of joists.

**1s**

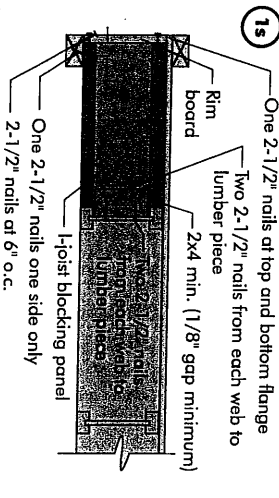


**Notes:**

- In some local codes, blocking is prescriptively required in the first joist space (or first and second joist space) next to the starter joist. Where required, see local code requirements for spacing of the blocking.
- All nails are common spiral in this detail.




## CANTILEVER DETAILS FOR BALCONIES (NO WALL LOAD)

### 3a I-JOIST CANTILEVER DETAIL FOR BALCONIES (No Wall Load)

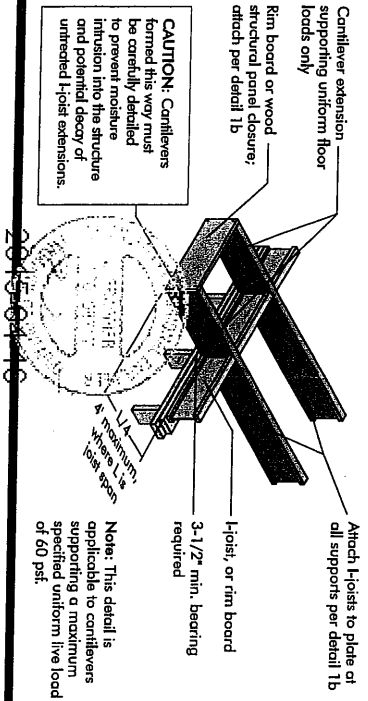


### 3b LUMBER CANTILEVER DETAIL FOR BALCONIES (No Wall Load)

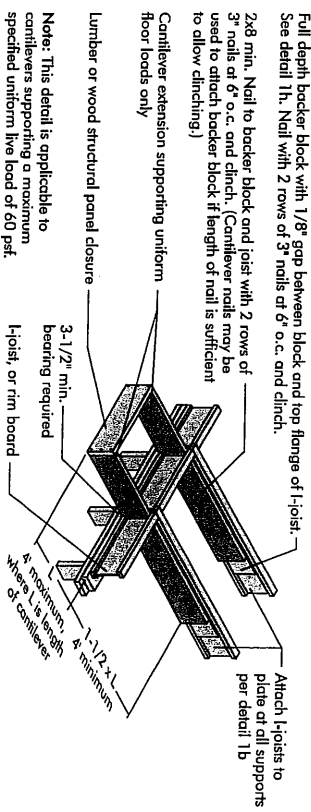

## CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET (CONCENTRATED WALL LOAD)

### 4a Method 1 — SHEATHING REINFORCEMENT ONE SIDE

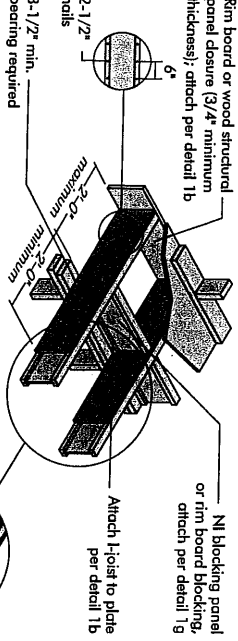

### Method 2 — SHEATHING REINFORCEMENT TWO SIDES

- Use same installation as Method 1 but reinforce both sides of I-joist with sheathing.
- Use nailing pattern shown for Method 1 with opposite face nailing offset by 3".

Note: Canadian softwood plywood sheathing or equivalent (minimum thickness 3/4") required on sides of joist. Depth shall match the full height of the joist. Nail with 2-1/2" nails at 6" o.c., top and bottom flange. Install with face grain horizontal. Attach I-joist to plate at all supports per detail 1b. Verify reinforced I-joist capacity.

### 4b Alternate Method 2 — DOUBLE I-JOIST


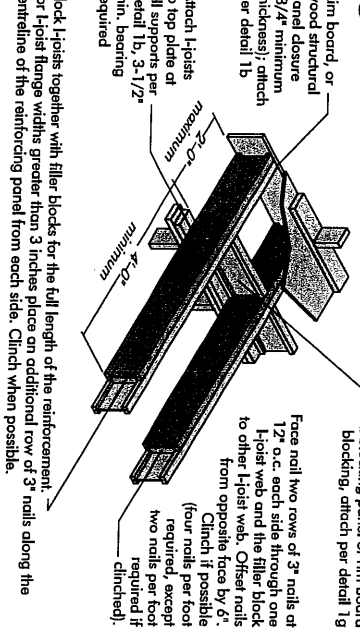


FIGURE 4 (continued)



### CANTILEVER REINFORCEMENT METHODS ALLOWED

JOIST DEPTH (in.)	ROOF TRUSS SPAN (ft)				ROOF LOADING (UNFACTORED)				ROOF TRUSS SPAN (ft)			
	LL = 30 psf, DL = 15 psf JOIST SPACING (in.)				LL = 40 psf, DL = 15 psf JOIST SPACING (in.)				LL = 50 psf, DL = 15 psf JOIST SPACING (in.)			
12	12	16	19.2	24	12	16	19.2	24	12	16	19.2	24
16	16	20	24	32	16	20	24	32	16	20	24	32
20	20	24	28	36	20	24	28	36	20	24	28	36
24	24	28	32	40	24	28	32	40	24	28	32	40
28	28	32	36	44	28	32	36	44	28	32	36	44
32	32	36	40	48	32	36	40	48	32	36	40	48
36	36	40	44	52	36	40	44	52	36	40	44	52
40	40	44	48	56	40	44	48	56	40	44	48	56
44	44	48	52	60	44	48	52	60	44	48	52	60
48	48	52	56	64	48	52	56	64	48	52	56	64
52	52	56	60	68	52	56	60	68	52	56	60	68
56	56	60	64	72	56	60	64	72	56	60	64	72
60	60	64	68	76	60	64	68	76	60	64	68	76
64	64	68	72	80	64	68	72	80	64	68	72	80
68	68	72	76	84	68	72	76	84	68	72	76	84
72	72	76	80	88	72	76	80	88	72	76	80	88
76	76	80	84	92	76	80	84	92	76	80	84	92
80	80	84	88	96	80	84	88	96	80	84	88	96
84	84	88	92	100	84	88	92	100	84	88	92	100
88	88	92	96	104	88	92	96	104	88	92	96	104
92	92	96	100	108	92	96	100	108	92	96	100	108
96	96	100	104	112	96	100	104	112	96	100	104	112
100	100	104	108	116	100	104	108	116	100	104	108	116
104	104	108	112	120	104	108	112	120	104	108	112	120
108	108	112	116	124	108	112	116	124	108	112	116	124
112	112	116	120	128	112	116	120	128	112	116	120	128
116	116	120	124	132	116	120	124	132	116	120	124	132
120	120	124	128	136	120	124	128	136	120	124	128	136
124	124	128	132	140	124	128	132	140	124	128	132	140
128	128	132	136	144	128	132	136	144	128	132	136	144
132	132	136	140	148	132	136	140	148	132	136	140	148
136	136	140	144	152	136	140	144	152	136	140	144	152
140	140	144	148	156	140	144	148	156	140	144	148	156
144	144	148	152	160	144	148	152	160	144	148	152	160
148	148	152	156	164	148	152	156	164	148	152	156	164
152	152	156	160	168	152	156	160	168	152	156	160	168
156	156	160	164	172	156	160	164	172	156	160	164	172
160	160	164	168	176	160	164	168	176	160	164	168	176
164	164	168	172	180	164	168	172	180	164	168	172	180
168	168	172	176	184	168	172	176	184	168	172	176	184
172	172	176	180	188	172	176	180	188	172	176	180	188
176	176	180	184	192	176	180	184	192	176	180	184	192
180	180	184	188	196	180	184	188	196	180	184	188	196
184	184	188	192	200	184	188	192	200	184	188	192	200
188	188	192	196	204	188	192	196	204	188	192	196	204
192	192	196	200	208	192	196	200	208	192	196	200	208
196	196	200	204	212	196	200	204	212	196	200	204	212
200	200	204	208	216	200	204	208	216	200	204	208	216
204	204	208	212	220	204	208	212	220	204	208	212	220
208	208	212	216	224	208	212	216	224	208	212	216	224
212	212	216	220	228	212	216	220	228	212	216	220	228
216	216	220	224	232	216	220	224	232	216	220	224	232
220	220	224	228	236	220	224	228	236	220	224	228	236
224	224	228	232	240	224	228	232	240	224	228	232	240
228	228	232	236	244	228	232	236	244	228	232	236	244
232	232	236	240	248	232	236	240	248	232	236	240	248
236	236	240	244	252	236	240	244	252	236	240	244	252
240	240	244	248	256	240	244	248	256	240	244	248	256
244	244	248	252	260	244	248	252	260	244	248	252	260
248	248	252	256	264	248	252	256	264	248	252	256	264
252	252	256	260	268	252	256	260	268	252	256	260	268
256	256	260	264	272	256	260	264	272	256	260	264	272
260	260	264	268	276	260	264	268	276	260	264	268	276
264	264	268	272	280	264	268	272	280	264	268	272	280
268	268	272	276	284	268	272	276	284	268	272	276	284
272	272	276	280	288	272	276	280	288	272	276	280	288
276	276	280	284	292	276	280	284	292	276	280	284	292
280	280	284	288	296	280	284	288	296	280	284	288	296
284	284	288	292	300	284	288	292	300	284	288	292	300
288	288	292	296	304	288	292	296	304	288	292	296	304
292	292	296	300	308	292	296	300	308	292	296	300	308
296	296	300	304	312	296	300	304	312	296	300	304	312
300	300	304	308	316	300	304	308	316	300	304	308	316
304	304	308	312	320	304	308	312	320	304	308	312	320
308	308	312	316	324	308	312	316	324	308	312	316	324
312	312	316	320	328	312	316	320	328	312	316	320	328
316	316	320	324	332	316	320	324	332	316	320	324	332
320	320	324	328	336	320	324	328	336	320	324	328	336
324	324	328	332	340	324	328	332	340	324	328	332	340
328	328	332	336	344	328	332	336	344	328	332	336	344
332	332	336	340	348	332	336	340	348	332	336	340	348
336	336	340	344	352	336	340	344	352	336	340	344	352
340	340	344	348	356	340	344	348	356	340	344	348	356
344	344	348	352	360	344	348	352	360	344	348	352	360
348	348	352	356	364	348	352	356	364	348	352	356	364
352	352	356	360	368	352	356	360	368	352	356	360	368
356	356	360	364	372	356	360	364	372	356	360	364	372
360	360	364	368	376	360	364	368	376	360	364	368	376
364	364	368	372	380	364	368	372	380	364	368	372	380
368	368	372	376	384	368	372	376	384	368	372	376	384
372	372	376	380	388	372	376	380	388	372	376	380	388
376	376	380	384	392	376	380	384	392	376	380	384	392
380	380	384	388	396	380	384	388	396	380	384	388	396
384	384	388	392	400	384	388	392	400	384	388	392	400
388	388	392	396	404	388	392	396	404	388	392	396	404
392	392	396	400	408	392	396	400	408	392	396	400	408
396	396	400	404	412	396	400	404	412	396	400	404	412
400	400	404	408	416	400	404	408	416	400	404	408	416
404	404	408	412	420	404	408	412	420	404	408	412	420
408	408	412	416	424	408	412	416	424	408	412	416	424
412	412	416	420	428	412	416	420	428	412	416	420	428
416	416	420	424	432	416	420	424	432	416	420	424	432
420	420	424	428	436	420	424	428	436	420	424	428	436
424	424	428	432	440	424	428	432	440	424	428	432	440
428	428	432	436	444	428	432	436	444	428	432	436	444
432	432	436	440	448	432	436	440	448	432	436	440	448
436	436	440	444	452	436	440	444	452	436	440	444	452
440	440	444	448	456	440	444	448	456	440	444	448	456
444	444	448	452	460	444	448	452	460	444	448	452	460
448	448	452	456	464	448	452	456	464	448	452	456	464
452	452	456	460	468	452	456	460	468	452	456	460	468
456	456	460	464	472	456	460	464	472	456	460	464	472
460	460	464	468	476	460	464	468	476	460	464	468	476
464	464	468	472	480	464	468	472	480	464	468	472	480
468	468	472	476	484	468	472	476	484	468	472	476	484
472	472	476	480	488	472	47						

## **RULES FOR CUTTING HOLES AND DUCT CHASE OPENINGS:**

## **RULES FOR CUTTING HOLES AND DUCT CHASE OPENINGS:**


1. The distance between the inside edge of the support and the centerline of any hole or duct chase opening shall be in compliance with the requirements of Table 1 or 2, respectively.
2. I-joist top and bottom flanges must NEVER be cut, notched, or otherwise modified.
3. Whenever possible, field-cut holes should be centered on the middle of the web.
4. The maximum size hole or the maximum depth of a duct chase opening that can be cut into an I-joist web shall equal the clear distance between the flanges of the I-joist minus 1/4 inch. A minimum of 1/8 inch should always be maintained between the top or bottom of the hole or opening and the adjacent I-joist flange.
5. The sides of square holes or longest sides of rectangular holes should not exceed 3/4 of the diameter of the maximum round hole permitted at that location.
6. Where more than one hole is necessary, the distance between adjacent hole edges shall exceed twice the diameter of the largest round hole or twice the size of the largest square hole (or twice the length of the longest side of the longest rectangular hole or duct chase opening), and each hole and duct chase opening shall be sized and located in compliance with the requirements of Tables 1 and 2, respectively.
7. A knockout is **not** considered a hole, may be utilized anywhere it occurs, and may be ignored for purposes of calculating minimum distances between holes and/or duct chase openings.
8. Holes measuring 1-1/2 inches or smaller shall be permitted anywhere in a cantilevered section of a joist. Holes of greater size may be permitted subject to verification.
9. A 1-1/2 inch hole or smaller can be placed anywhere in the web provided that it meets the requirements of rule number 6 above.
10. All holes and duct chase openings shall be cut in a workman-like manner in accordance with the restrictions listed above and as illustrated in Figure 7.
11. Limit three maximum size holes per span, of which one may be a duct chase opening.
12. A group of round holes at approximately the same location shall be permitted if they meet the requirements for a single round hole circumscribed around them.

See Table 1 for minimum distance from bearing

2x diameter of larger hole

2x duct chase length or hole diameter, whichever is larger

Duct chase opening (see Table 2 for minimum distance from bearing)

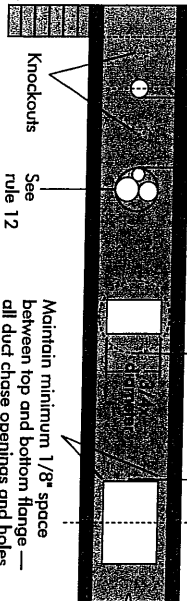

A knockout is **NOT** considered a hole, may be utilized wherever it occurs and may be ignored for purposes of calculating minimum distances between holes.

**TABLE 1**  
**LOCATION OF CIRCULAR HOLES IN JOIST WEBS**  
Simple or Multiple Span for Dead Loads up to 15 psf and Live Loads up to 40 psf

[illegible]

1. Above table may be used for I-joist spacing of 24 inches on centre or less.
2. Hole location distance is measured from inside face of supports to centre of hole
3. Distances in this chart are based on uniformly loaded joists.

**OPTIONAL:**

Reduced =  $\frac{\text{Actual}}{\text{D}}$  x D

$$\text{Reduced} = \frac{\text{Actual}}{\text{SAF}} \times D$$

**Where:**

**L**actual

SAF-  
D

Distance from the inside face of any support to centre of hole, reduced for less-than-maximum distance shall not be less than 6 inches from the face of the support to edge of the hole. The actual measured span distance between the inside faces of supports [d].

Span Adjustment Factor given in this table.

The minimum distance from the inside face of any support to centre of hole from this table if Section is greater than 1, use 1 in the above calculation for  $\frac{\text{SAF}}{\text{SAE}}$ .

**TABLE 2**  
**DUCT CHASE OPENING SIZES AND LOCATIONS — Simple Span Only**

Joist Depth	Joist Series	Duct chase length (in.)									
		8	10	12	14	16	18	20	22	24	
10	8	4.5	4.10	3.75	3.40	3.05	2.70	2.35	2.00	1.65	
	10	5.0	4.65	4.30	3.95	3.60	3.25	2.90	2.55	2.20	
	12	5.5	5.15	4.80	4.45	4.10	3.75	3.40	3.05	2.70	
	14	6.0	5.65	5.30	4.95	4.60	4.25	3.90	3.55	3.20	
	16	6.5	6.15	5.80	5.45	5.10	4.75	4.40	4.05	3.70	
	18	7.0	6.65	6.30	5.95	5.60	5.25	4.90	4.55	4.20	
	20	7.5	7.15	6.80	6.45	6.10	5.75	5.40	5.05	4.70	
	22	8.0	7.65	7.30	6.95	6.60	6.25	5.90	5.55	5.20	
	24	8.5	8.15	7.80	7.45	7.10	6.75	6.40	6.05	5.70	
	26	9.0	8.65	8.30	7.95	7.60	7.25	6.90	6.55	6.20	
12	10	5.0	4.65	4.30	3.95	3.60	3.25	2.90	2.55	2.20	
	12	5.5	5.15	4.80	4.45	4.10	3.75	3.40	3.05	2.70	
	14	6.0	5.65	5.30	4.95	4.60	4.25	3.90	3.55	3.20	
	16	6.5	6.15	5.80	5.45	5.10	4.75	4.40	4.05	3.70	
	18	7.0	6.65	6.30	5.95	5.60	5.25	4.90	4.55	4.20	
	20	7.5	7.15	6.80	6.45	6.10	5.75	5.40	5.05	4.70	
	22	8.0	7.65	7.30	6.95	6.60	6.25	5.90	5.55	5.20	
	24	8.5	8.15	7.80	7.45	7.10	6.75	6.40	6.05	5.70	
	26	9.0	8.65	8.30	7.95	7.60	7.25	6.90	6.55	6.20	
	28	9.5	9.15	8.80	8.45	8.10	7.75	7.40	7.05	6.70	
14	12	5.5	5.15	4.80	4.45	4.10	3.75	3.40	3.05	2.70	
	14	6.0	5.65	5.30	4.95	4.60	4.25	3.90	3.55	3.20	
	16	6.5	6.15	5.80	5.45	5.10	4.75	4.40	4.05	3.70	
	18	7.0	6.65	6.30	5.95	5.60	5.25	4.90	4.55	4.20	
	20	7.5	7.15	6.80	6.45	6.10	5.75	5.40	5.05	4.70	
	22	8.0	7.65	7.30	6.95	6.60	6.25	5.90	5.55	5.20	
	24	8.5	8.15	7.80	7.45	7.10	6.75	6.40	6.05	5.70	
	26	9.0	8.65	8.30	7.95	7.60	7.25	6.90	6.55	6.20	
	28	9.5	9.15	8.80	8.45	8.10	7.75	7.40	7.05	6.70	
	30	10.0	9.65	9.30	8.95	8.60	8.25	7.90	7.55	7.20	
16	14	6.0	5.65	5.30	4.95	4.60	4.25	3.90	3.55	3.20	
	16	6.5	6.15	5.80	5.45	5.10	4.75	4.40	4.05	3.70	
	18	7.0	6.65	6.30	5.95	5.60	5.25	4.90	4.55	4.20	
	20	7.5	7.15	6.80	6.45	6.10	5.75	5.40	5.05	4.70	
	22	8.0	7.65	7.30	6.95	6.60	6.25	5.90	5.55	5.20	
	24	8.5	8.15	7.80	7.45	7.10	6.75	6.40	6.05	5.70	
	26	9.0	8.65	8.30	7.95	7.60	7.25	6.90	6.55	6.20	
	28	9.5	9.15	8.80	8.45	8.10	7.75	7.40	7.05	6.70	
	30	10.0	9.65	9.30	8.95	8.60	8.25	7.90	7.55	7.20	
	32	10.5	10.15	9.80	9.45	9.10	8.75	8.40	8.05	7.70	
18	16	6.5	6.15	5.80	5.45	5.10	4.75	4.40	4.05	3.70	
	18	7.0	6.65	6.30	5.95	5.60	5.25	4.90	4.55	4.20	
	20	7.5	7.15	6.80	6.45	6.10	5.75	5.40	5.05	4.70	
	22	8.0	7.65	7.30	6.95	6.60	6.25	5.90	5.55	5.20	
	24	8.5	8.15	7.80	7.45	7.10	6.75	6.40	6.05	5.70	
	26	9.0	8.65	8.30	7.95	7.60	7.25	6.90	6.55	6.20	
	28	9.5	9.15	8.80	8.45	8.10	7.75	7.40	7.05	6.70	
	30	10.0	9.65	9.30	8.95	8.60	8.25	7.90	7.55	7.20	
	32	10.5	10.15	9.80	9.45	9.10	8.75	8.40	8.05	7.70	
	34	11.0	10.65	10.30	9.95	9.60	9.25	8.90	8.55	8.20	
20	18	7.0	6.65	6.30	5.95	5.60	5.25	4.90	4.55	4.20	
	20	7.5	7.15	6.80	6.45	6.10	5.75	5.40	5.05	4.70	
	22	8.0	7.65	7.30	6.95	6.60	6.25	5.90	5.55	5.20	
	24	8.5	8.15	7.80	7.45	7.10	6.75	6.40	6.05	5.70	
	26	9.0	8.65	8.30	7.95	7.60	7.25	6.90	6.55	6.20	
	28	9.5	9.15	8.80	8.45	8.10	7.75	7.40	7.05	6.70	
	30	10.0	9.65	9.30	8.95	8.60	8.25	7.90	7.55	7.20	
	32	10.5	10.15	9.80	9.45	9.10	8.75	8.40	8.05	7.70	
	34	11.0	10.65	10.30	9.95	9.60	9.25	8.90	8.55	8.20	
	36	11.5	11.15	10.80	10.45	10.10	9.75	9.40	9.05	8.70	
22	20	7.5	7.15	6.80	6.45	6.10	5.75	5.40	5.05	4.70	
	22	8.0	7.65	7.30	6.95	6.60	6.25	5.90	5.55	5.20	
	24	8.5	8.15	7.80	7.45	7.10	6.75	6.40	6.05	5.70	
	26	9.0	8.65	8.30	7.95	7.60	7.25	6.90	6.55	6.20	
	28	9.5	9.15	8.80	8.45	8.10	7.75	7.40	7.05	6.70	
	30	10.0	9.65	9.30	8.95	8.60	8.25	7.90	7.55	7.20	
	32	10.5	10.15	9.80	9.45	9.10	8.75	8.40	8.05	7.70	
	34	11.0	10.65	10.30	9.95	9.60	9.25	8.90	8.55	8.20	
	36	11.5	11.15	10.80	10.45	10.10	9.75	9.40	9.05	8.70	
	38	12.0	11.65	11.30	10.95	10.60	10.25	9.90	9.55	9.20	
24	22	8.0	7.65	7.30	6.95	6.60	6.25	5.90	5.55	5.20	
	24	8.5	8.15	7.80	7.45	7.10	6.75	6.40	6.05	5.70	
	26	9.0	8.65	8.30	7.95	7.60	7.25	6.90	6.55	6.20	
	28	9.5	9.15	8.80	8.45	8.10	7.75	7.40	7.05	6.70	
	30	10.0	9.65	9.30	8.95	8.60	8.25	7.90	7.55	7.20	
	32	10.5	10.15	9.80	9.45	9.10	8.75	8.40	8.05	7.70	
	34	11.0	10.65	10.30	9.95	9.60	9.25	8.90	8.55	8.20	
	36	11.5	11.15	10.80	10.45	10.10	9.75	9.40	9.05	8.70	
	38	12.0	11.65	11.30	10.95	10.60	10.25	9.90	9.55	9.20	
	40	12.5	12.15	11.80	11.45	11.10	10.75	10.40	10.05	9.70	
26	24	8.5	8.15	7.80	7.45	7.10	6.75	6.40	6.05	5.70	
	26	9.0	8.65	8.30	7.95	7.60	7.25	6.90	6.55	6.20	
	28	9.5	9.15	8.80	8.45	8.10	7.75	7.40	7.05	6.70	
	30	10.0	9.65	9.30	8.95	8.60	8.25	7.90	7.55	7.20	
	32	10.5	10.15	9.80	9.45	9.10	8.75	8.40	8.05	7.70	
	34	11.0	10.65	10.30	9.95	9.60	9.25	8.90	8.55	8.20	
	36	11.5	11.15	10.80	10.45	10.10	9.75	9.40	9.05	8.70	
	38	12.0	11.65	11.30	10.95	10.60	10.25	9.90	9.55	9.20	
	40	12.5	12.15	11.80	11.45	11.10	10.75	10.40	10.05	9.70	
	42	13.0	12.65	12.30	11.95	11.60	11.25	10.90	10.55	10.20	
28	26	9.0	8.65	8.30	7.95	7.60	7.25	6.90	6.55	6.20	
	28	9.5	9.15	8.80	8.45	8.10	7.75	7.40	7.05	6.70	
	30	10.0	9.65	9.30	8.95	8.60	8.25	7.90	7.55	7.20	
	32	10.5	10.15	9.80	9.45	9.10	8.75	8.40	8.05	7.70	
	34	11.0	10.65	10.30	9.95	9.60	9.25	8.90	8.55	8.20	
	36	11.5	11.15	10.80	10.45	10.10	9.75	9.40	9.05	8.70	
	38	12.0	11.65	11.30	10.95	10.60	10.25	9.90	9.55	9.20	
	40	12.5	12.15	11.80	11.45	11.10	10.75	10.40	10.05	9.70	
	42	13.0	12.65	12.30	11.95	11.60	11.25	10.90	10.55	10.20	
	44	13.5	13.15	12.80	12.45	12.10	11.75	11.40	11.05	10.70	
30	28	9.5	9.15	8.80	8.45	8.10	7.75	7.40	7.05	6.70	
	30	10.0	9.65	9.30	8.95	8.60	8.25	7.90	7.55	7.20	
	32	10.5	10.15	9.80	9.45	9.10	8.75	8.40	8.05	7.70	
	34	11.0	10.65	10.30	9.95	9.60	9.25	8.90	8.55	8.20	
	36	11.5	11.15	10.80	10.45	10.10	9.75	9.40	9.05	8.70	
	38	12.0	11.65	11.30	10.95	10.60	10.25	9.90	9.55	9.20	
	40	12.5	12.15	11.80	11.45	11.10	10.75	10.40	10.05	9.70	
	42	13.0	12.65	12.30	11.95	11.60	11.25	10.90	10.55	10.20	
	44	13.5	13.15	12.80	12.45	12.10	11.75	11.40	11.05	10.70	
	46	14.0	13.65	13.30	12.95	12.60	12.25	11.90	11.55	11.20	
32	30	10.0	9.65	9.30	8.95	8.60	8.25	7.90	7.55	7.20	
	32	10.5	10.15	9.80	9.45	9.10	8.75	8.40	8.05	7.70	
	34	11.0	10.65	10.30	9.95	9.60	9.25	8.90	8.55	8.20	
	36	11.5	11.15	10.80	10.45	10.10	9.75	9.40	9.05	8.70	
	38	12.0	11.65	11.30	10.95	10.60	10.25	9.90	9.55	9.20	
	40	12.5	12.15	11.80	11.45	11.10	10.75	10.40	10.05	9.70	
	42	13.0	12.65	12.30	11.95	11.60	11.25	10.90	10.55	10.20	
	44	13.5	13.15	12.80	12.45	12.10	11.75	11.40	11.05	10.70	
	46	14.0	13.65	13.30	12.95	12.60	12.25	11.90	11.55	11.20	
	48	14.5	14.15	13.80	13.45	13.10	12.75	12.40	12.05	11.70	
34	32	10.5	10.15	9.80	9.45	9.10	8.75	8.40	8.05	7.70	
	34	11.0	10.65	10.30	9.95	9.60	9.25	8.90	8.55	8.20	
	36	11.5	11.15	10.80	10.45	10.10	9.75	9.40	9.05	8.70	
	38	12.0	11.65	11.30	10.95	10.60	10.25	9.90	9.55	9.20	
	40	12.5	12.15	11.80	11.45	11.10	10.75	10.40	10.05	9.70	
	42	13.0	12.65	12.30	11.95	11.60	11.25	10.90	10.55	10.20	
	44	13.5	13.15	12.80	12.45	12.10	11.75	11.40	11.05	10.70	
	46	14.0	13.65	13.30	12.95	12.60	12.25	11.90	11.55	11.20	
	48	14.5	14.15	13.80	13.45	13.10	12.75	12.40	12.05	11.70	
	50	15.0	14.65	14.30	13.95	13.60	13.25	12.90			

1. Above table may be used for I-joint spacing of 24 inches on centre or less.
2. Duct chase opening location distance is measured from inside face of supports to centre of opening.
3. The above table is based on simple-span joists only. For other applications, contact your local distributor.
4. Distances are based on uniformly loaded floor joists that meet the span requirements for a design live load of 40 psf and dead load of 15 psf, and a live load deflection limit of L/480. For other applications, contact your local distributor.

Maximum Fee: \$600  
Minimum fee: The reduced  
2015-04-16




# BRICK CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET (CONCENTRATED WALL LOAD)

## 5a SHEATHING REINFORCEMENT

Provide full depth blocking between joists over support (not shown)


**Note:** Canadian softwood plywood sheathing or equivalent (minimum thickness 3/4") required on sides of joist. Depth shall match the full height of the joist. Nail with 2-1/2" nails at 6" o.c., top and bottom flange. Install with face grain horizontal. Attach I-joist to plate at all supports per detail 1b. Verify reinforced I-joist capacity.

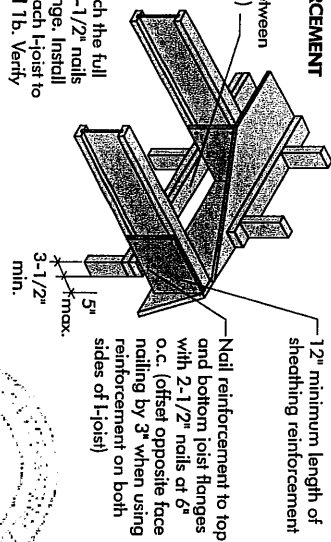

## 5b SET-BACK DETAIL


Rim board or wood structural panel closure (3/4" minimum thickness), attach per detail 1b.

**Notes:**  
- Provide full depth blocking between joists over support (not shown for clarity)  
- Attach I-joist to plate at all supports per detail 1b.  
- 3-1/2" minimum I-joist bearing required.

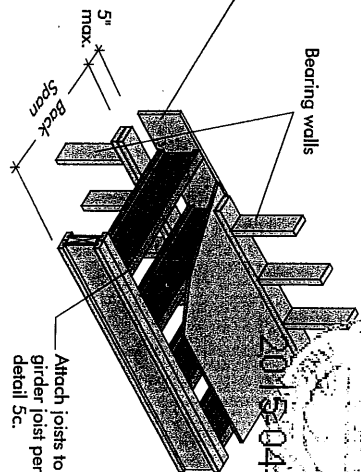



## 5c SET-BACK CONNECTION

Vertical solid sawn blocks (2x6 S-P-F No. 2 or better) nailed through joist web and web of girder using 2-1/2" nails.

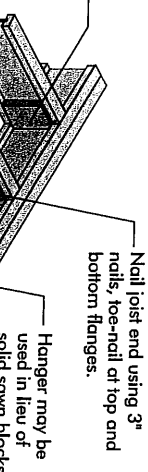

**Notes:**  
- Verify girder joist capacity, if the back span exceeds the joist spacing.  
- Attach double I-joist per detail 1p, if required.

FIGURE 5 (continued)

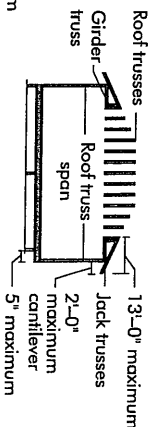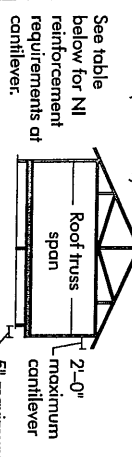

For hip roofs with the jack trusses running parallel to the cantilevered floor joists, the I-joist reinforcement requirements for a span of 26 ft. shall be permitted to be used.

## BRICK CANTILEVER REINFORCEMENT METHODS ALLOWED

JOIST DEPTH (in.)	ROOF TRUSS SPAN (ft)		ROOF LOADING (UNFACTORED)				LL = 50 psf, DL = 15 psf			
	12	16	19.2	24	12	16	19.2	24	12	16
12	1	1	1	1	1	1	1	1	1	1
14	1	1	1	1	1	1	1	1	1	1
16	1	1	1	1	1	1	1	1	1	1
18	1	1	1	1	1	1	1	1	1	1
20	1	1	1	1	1	1	1	1	1	1
22	1	1	1	1	1	1	1	1	1	1
24	1	1	1	1	1	1	1	1	1	1
26	1	1	1	1	1	1	1	1	1	1
28	1	1	1	1	1	1	1	1	1	1
30	1	1	1	1	1	1	1	1	1	1
32	1	1	1	1	1	1	1	1	1	1
34	1	1	1	1	1	1	1	1	1	1
36	1	1	1	1	1	1	1	1	1	1
38	1	1	1	1	1	1	1	1	1	1
40	1	1	1	1	1	1	1	1	1	1
42	1	1	1	1	1	1	1	1	1	1
44	1	1	1	1	1	1	1	1	1	1
46	1	1	1	1	1	1	1	1	1	1
48	1	1	1	1	1	1	1	1	1	1
50	1	1	1	1	1	1	1	1	1	1
52	1	1	1	1	1	1	1	1	1	1
54	1	1	1	1	1	1	1	1	1	1
56	1	1	1	1	1	1	1	1	1	1
58	1	1	1	1	1	1	1	1	1	1
60	1	1	1	1	1	1	1	1	1	1
62	1	1	1	1	1	1	1	1	1	1
64	1	1	1	1	1	1	1	1	1	1
66	1	1	1	1	1	1	1	1	1	1
68	1	1	1	1	1	1	1	1	1	1
70	1	1	1	1	1	1	1	1	1	1
72	1	1	1	1	1	1	1	1	1	1
74	1	1	1	1	1	1	1	1	1	1
76	1	1	1	1	1	1	1	1	1	1
78	1	1	1	1	1	1	1	1	1	1
80	1	1	1	1	1	1	1	1	1	1
82	1	1	1	1	1	1	1	1	1	1
84	1	1	1	1	1	1	1	1	1	1
86	1	1	1	1	1	1	1	1	1	1
88	1	1	1	1	1	1	1	1	1	1
90	1	1	1	1	1	1	1	1	1	1
92	1	1	1	1	1	1	1	1	1	1
94	1	1	1	1	1	1	1	1	1	1
96	1	1	1	1	1	1	1	1	1	1
98	1	1	1	1	1	1	1	1	1	1
100	1	1	1	1	1	1	1	1	1	1

1. N = No reinforcement required.
2. N = NI reinforced with 3/4" wood structural panel on one side only.
3. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
4. N = NI reinforced with 3/4" wood structural panel on one side only.
5. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
6. N = NI reinforced with 3/4" wood structural panel on one side only.
7. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
8. N = NI reinforced with 3/4" wood structural panel on one side only.
9. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
10. N = NI reinforced with 3/4" wood structural panel on one side only.
11. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
12. N = NI reinforced with 3/4" wood structural panel on one side only.
13. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
14. N = NI reinforced with 3/4" wood structural panel on one side only.
15. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
16. N = NI reinforced with 3/4" wood structural panel on one side only.
17. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
18. N = NI reinforced with 3/4" wood structural panel on one side only.
19. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
20. N = NI reinforced with 3/4" wood structural panel on one side only.
21. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
22. N = NI reinforced with 3/4" wood structural panel on one side only.
23. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
24. N = NI reinforced with 3/4" wood structural panel on one side only.
25. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
26. N = NI reinforced with 3/4" wood structural panel on one side only.
27. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
28. N = NI reinforced with 3/4" wood structural panel on one side only.
29. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
30. N = NI reinforced with 3/4" wood structural panel on one side only.
31. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
32. N = NI reinforced with 3/4" wood structural panel on one side only.
33. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
34. N = NI reinforced with 3/4" wood structural panel on one side only.
35. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
36. N = NI reinforced with 3/4" wood structural panel on one side only.
37. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
38. N = NI reinforced with 3/4" wood structural panel on one side only.
39. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
40. N = NI reinforced with 3/4" wood structural panel on one side only.
41. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
42. N = NI reinforced with 3/4" wood structural panel on one side only.
43. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
44. N = NI reinforced with 3/4" wood structural panel on one side only.
45. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
46. N = NI reinforced with 3/4" wood structural panel on one side only.
47. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
48. N = NI reinforced with 3/4" wood structural panel on one side only.
49. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
50. N = NI reinforced with 3/4" wood structural panel on one side only.
51. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
52. N = NI reinforced with 3/4" wood structural panel on one side only.
53. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
54. N = NI reinforced with 3/4" wood structural panel on one side only.
55. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
56. N = NI reinforced with 3/4" wood structural panel on one side only.
57. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
58. N = NI reinforced with 3/4" wood structural panel on one side only.
59. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
60. N = NI reinforced with 3/4" wood structural panel on one side only.
61. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
62. N = NI reinforced with 3/4" wood structural panel on one side only.
63. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
64. N = NI reinforced with 3/4" wood structural panel on one side only.
65. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
66. N = NI reinforced with 3/4" wood structural panel on one side only.
67. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
68. N = NI reinforced with 3/4" wood structural panel on one side only.
69. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
70. N = NI reinforced with 3/4" wood structural panel on one side only.
71. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
72. N = NI reinforced with 3/4" wood structural panel on one side only.
73. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
74. N = NI reinforced with 3/4" wood structural panel on one side only.
75. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
76. N = NI reinforced with 3/4" wood structural panel on one side only.
77. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
78. N = NI reinforced with 3/4" wood structural panel on one side only.
79. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
80. N = NI reinforced with 3/4" wood structural panel on one side only.
81. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
82. N = NI reinforced with 3/4" wood structural panel on one side only.
83. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
84. N = NI reinforced with 3/4" wood structural panel on one side only.
85. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
86. N = NI reinforced with 3/4" wood structural panel on one side only.
87. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
88. N = NI reinforced with 3/4" wood structural panel on one side only.
89. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
90. N = NI reinforced with 3/4" wood structural panel on one side only.
91. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
92. N = NI reinforced with 3/4" wood structural panel on one side only.
93. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
94. N = NI reinforced with 3/4" wood structural panel on one side only.
95. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
96. N = NI reinforced with 3/4" wood structural panel on one side only.
97. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
98. N = NI reinforced with 3/4" wood structural panel on one side only.
99. N = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
100. N = NI reinforced with 3/4" wood structural panel on one side only.

## INSTALLING THE GLUED FLOOR SYSTEM

1. Wipe any mud, dirt, water, or ice from I-joist flanges before gluing.
2. Snap a chalk line across the I-joists four feet in from the wall for panel edge alignment and as a boundary for spreading glue.
3. Spread only enough glue to lay one or two panels at a time, or follow specific recommendations from the glue manufacturer.
4. Lay the first panel with tongue side to the wall, and nail in place. This protects the tongue of the next panel from damage when topped into place with a block and sledgehammer.
5. Apply a continuous line of glue (about 1/4-inch diameter) to the top flange of a single I-joist. Apply glue in a winding pattern on wide areas, such as with double I-joists.
6. Apply two lines of glue on I-joists where panel ends butt to assure proper gluing of each end.
7. After the first row of panels is in place, spread glue in the groove of one or two panels at a time before laying the next row. Glue line may be continuous or spaced, but avoid squeeze-out by applying a thinner line (1/8 inch) than used on I-joist flanges.
8. Top the second row of panels into place, using a block to protect groove edges.
9. Stagger end joints in each succeeding row of panels. A 1/8-inch space between all end joints and 1/8-inch at all edges, including T&G edges, is recommended. (Use a spacer tool or an 2-1/2" common nail to assure accurate and consistent spacing.)
10. **Complete all nailing of each panel before glue sets.** Check the manufacturer's recommendations for cure time. (Warm weather accelerates glue setting.) Use 2" ring- or screw-shank nails for panels 3/4-inch thick or less, and 2-1/2" ring- or screw-shank nails for thicker panels. Space nails per the table below. Closer nail spacing may be required by some codes, or for diaphragm construction. The finished deck can be walked on right away and will carry construction loads without damage to the glue bond.

### FASTENERS FOR SHEATHING AND SUBFLOORING(1)

Maximum Joist Spacing (in.)	Minimum Panel Thickness (in.)	Common Wire or Spiral Nails	Nail Size and Type	Staples	Maximum Spacing of Fasteners	Edges	Intern. Supports
16	5/8	2"	1-3/4"	2"	6"		12"
20	5/8	2"	1-3/4"	2"	6"		12"
24	3/4	2"	1-3/4"	2"	6"		12"

1. Fasteners of sheathing and subflooring shall conform to the above table.
2. Staples shall not be less than 1/16-inch in diameter or thickness, with not less than a 3/8-inch crown driven with the crown parallel to framing.
3. Flooring screws shall not be less than 1/8-inch in diameter.
4. Special conditions may impose heavy traffic and concentrated loads that require construction in excess of the minimums shown.
5. Use only adhesives conforming to CAN/CGSB-71.26 Standard, Adhesives for Field-Gluing Plywood to Lumber Framing for Floor System, applied in accordance with the manufacturer's recommendations. If OSB panels with sealed surfaces and edges are to be used, use only solvent-based glues; check with panel manufacturer.

Ref.: NRC-CNRC, National Building Code of Canada 2010, Table 9.23.3.5.

#### IMPORTANT NOTE:

Floor sheathing must be field glued to the I-joist flanges in order to achieve the maximum spans shown in this document. If sheathing is nailed only, I-joist spans must be verified with your local distributor.


## RIM BOARD INSTALLATION DETAILS

### 8c ATTACHMENT DETAILS WHERE RIM BOARDS ABUT


#### Rim board Joint Between Floor Joists

2-1/2" nails at 6" o.c. (typical)


(1) 2-1/2" nail top and bottom (typical)

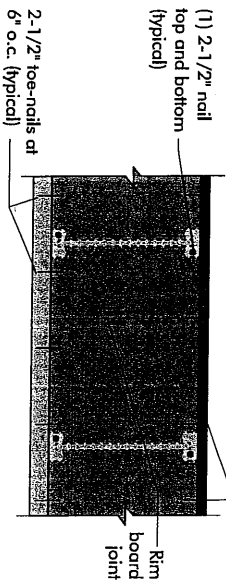


#### Rim board Joint at Corner

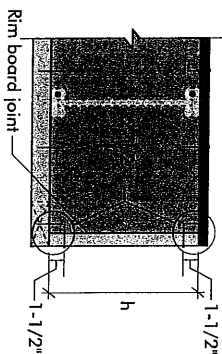

### 8b TOE-NAIL CONNECTION AT RIM BOARD



### 8c 2X LEDGER TO RIM BOARD ATTACHMENT DETAIL

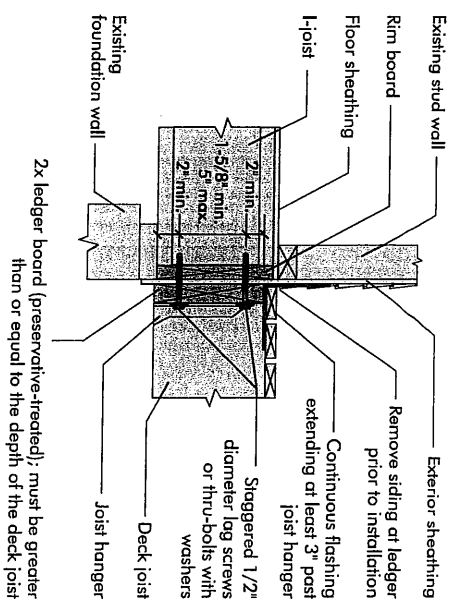


2015-04-16

## PRODUCT WARRANTY

Charlton's Charlene's warrants that, in accordance with our specifications, Noval products are free from manufacturing defects in material and workmanship.

Furthermore, Charlton's Charlene's warrants that our products, when installed in accordance with our handling and installation instructions, will meet or exceed our specifications for the lifetime of the structure.

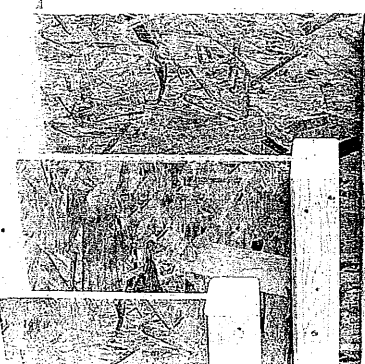


# MICRO CITY ENGINEERING SERVICES INC.

TEL: (519) 287 - 2242

R.R. #1, P.O. BOX 61, GLENCOE, ONTARIO, N0L 1M0

LVL HEADER AND CONVENTIONAL LUMBER NAILING DETAILS		
DETAIL NUMBER	NUMBER OF ROWS	SPACING (INCHES o/c) "d"
A	2	12
B	2	8
C	2	6
D	2	4
1A	3	12
1B	3	8
1C	3	6
1D	3	4
2A	4	12
2B	4	8
2C	4	6
2D	4	4
3A	5	12
3B	5	8
3C	5	6
3D	5	4
4A	6	12
4B	6	8
4C	6	6
4D	6	4

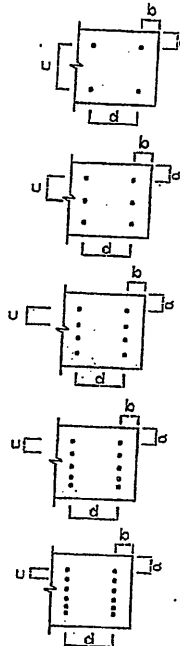

## NOTES:

- (1) MINIMUM LUMBER EDGE DISTANCE "a" = 1"
- (2) MINIMUM LUMBER END DISTANCE "b" = 2"
- (3) MINIMUM NAIL ROW SPACING "c" = 2"
- (4) STAGGER NAILS "d/2" BETWEEN PLYS FOR MULTI-PLY MEMBERS (3 PLY OR MORE)
- (5) ALL NAILS ARE 3-1/2" ARDOX SPIRAL NAILS
- (6) DO NOT USE AIR-DRIVEN NAILS



DWG NO TAMN/1001.14

STRUCTURAL  
COMPONENT ONLY

TO BE USED ONLY  
WITH BEAM CALCS  
BEARING THE  
STAMP BELOW

PROVIDE NAILING  
DETAIL # X SEE  
DWG #TAMN1001-14