


9/12 ROOF PITCH
UNLESS OTHERWISE
SPECIFIED

THIS STRUCTURE MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE PROVISIONS OF
THE ONTARIO BUILDING CODE

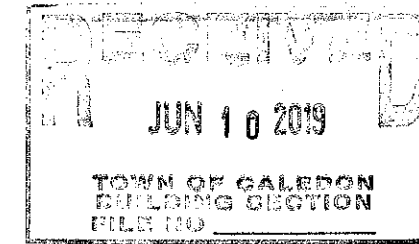

12 " FINISH O.H
R.T.M.C
2X6 EXTERIOR WALLS
ASPHALT SHINGLES
2X6 FASCIA BOARD

DESIGN LOADS:
SNOW LOAD 1.8 KPA
TC DEAD 6 PSF
BC LIVE 10.5 PSF
BC DEAD 7 PSF


ALL CONVENTIONAL ROOF
FRAMING TO CONFORM TO
PART 9 OF THE OBC. LATEST
EDITION ROOF RAFTERS
THAT MEET OR CROSS
OVER TRUSSES ARE TO BE
2"X4" SPF @24"o.c. WITH A
2"X4" SPF VERTICAL POST
TO THE TRUSS UNDER AT
EACH CROSS POINT. POSTS
LONGER THAN 6' TO BE
LATERALLY BRACED SO
THAT THE DISTANCE
BETWEEN END POINTS AND
BETWEEN ROWS OF
BRACING DOES NOT
EXCEED 6'.

TRUSSES DESIGNED
CONFORM TO THE
RELEVANT SECTION OF THE
LATEST EDITION OF THE
ONTARIO BUILDING CODE
(RESIDENTIAL PART 9)

HARDWARE
HGUS26-2(XX)
LUS26-2(VV)
LJS26DS(V) **BM2,4:2-2X10**
LUS24(O)

DENOTES
CONVENTIONAL
FRAMING

T- ...

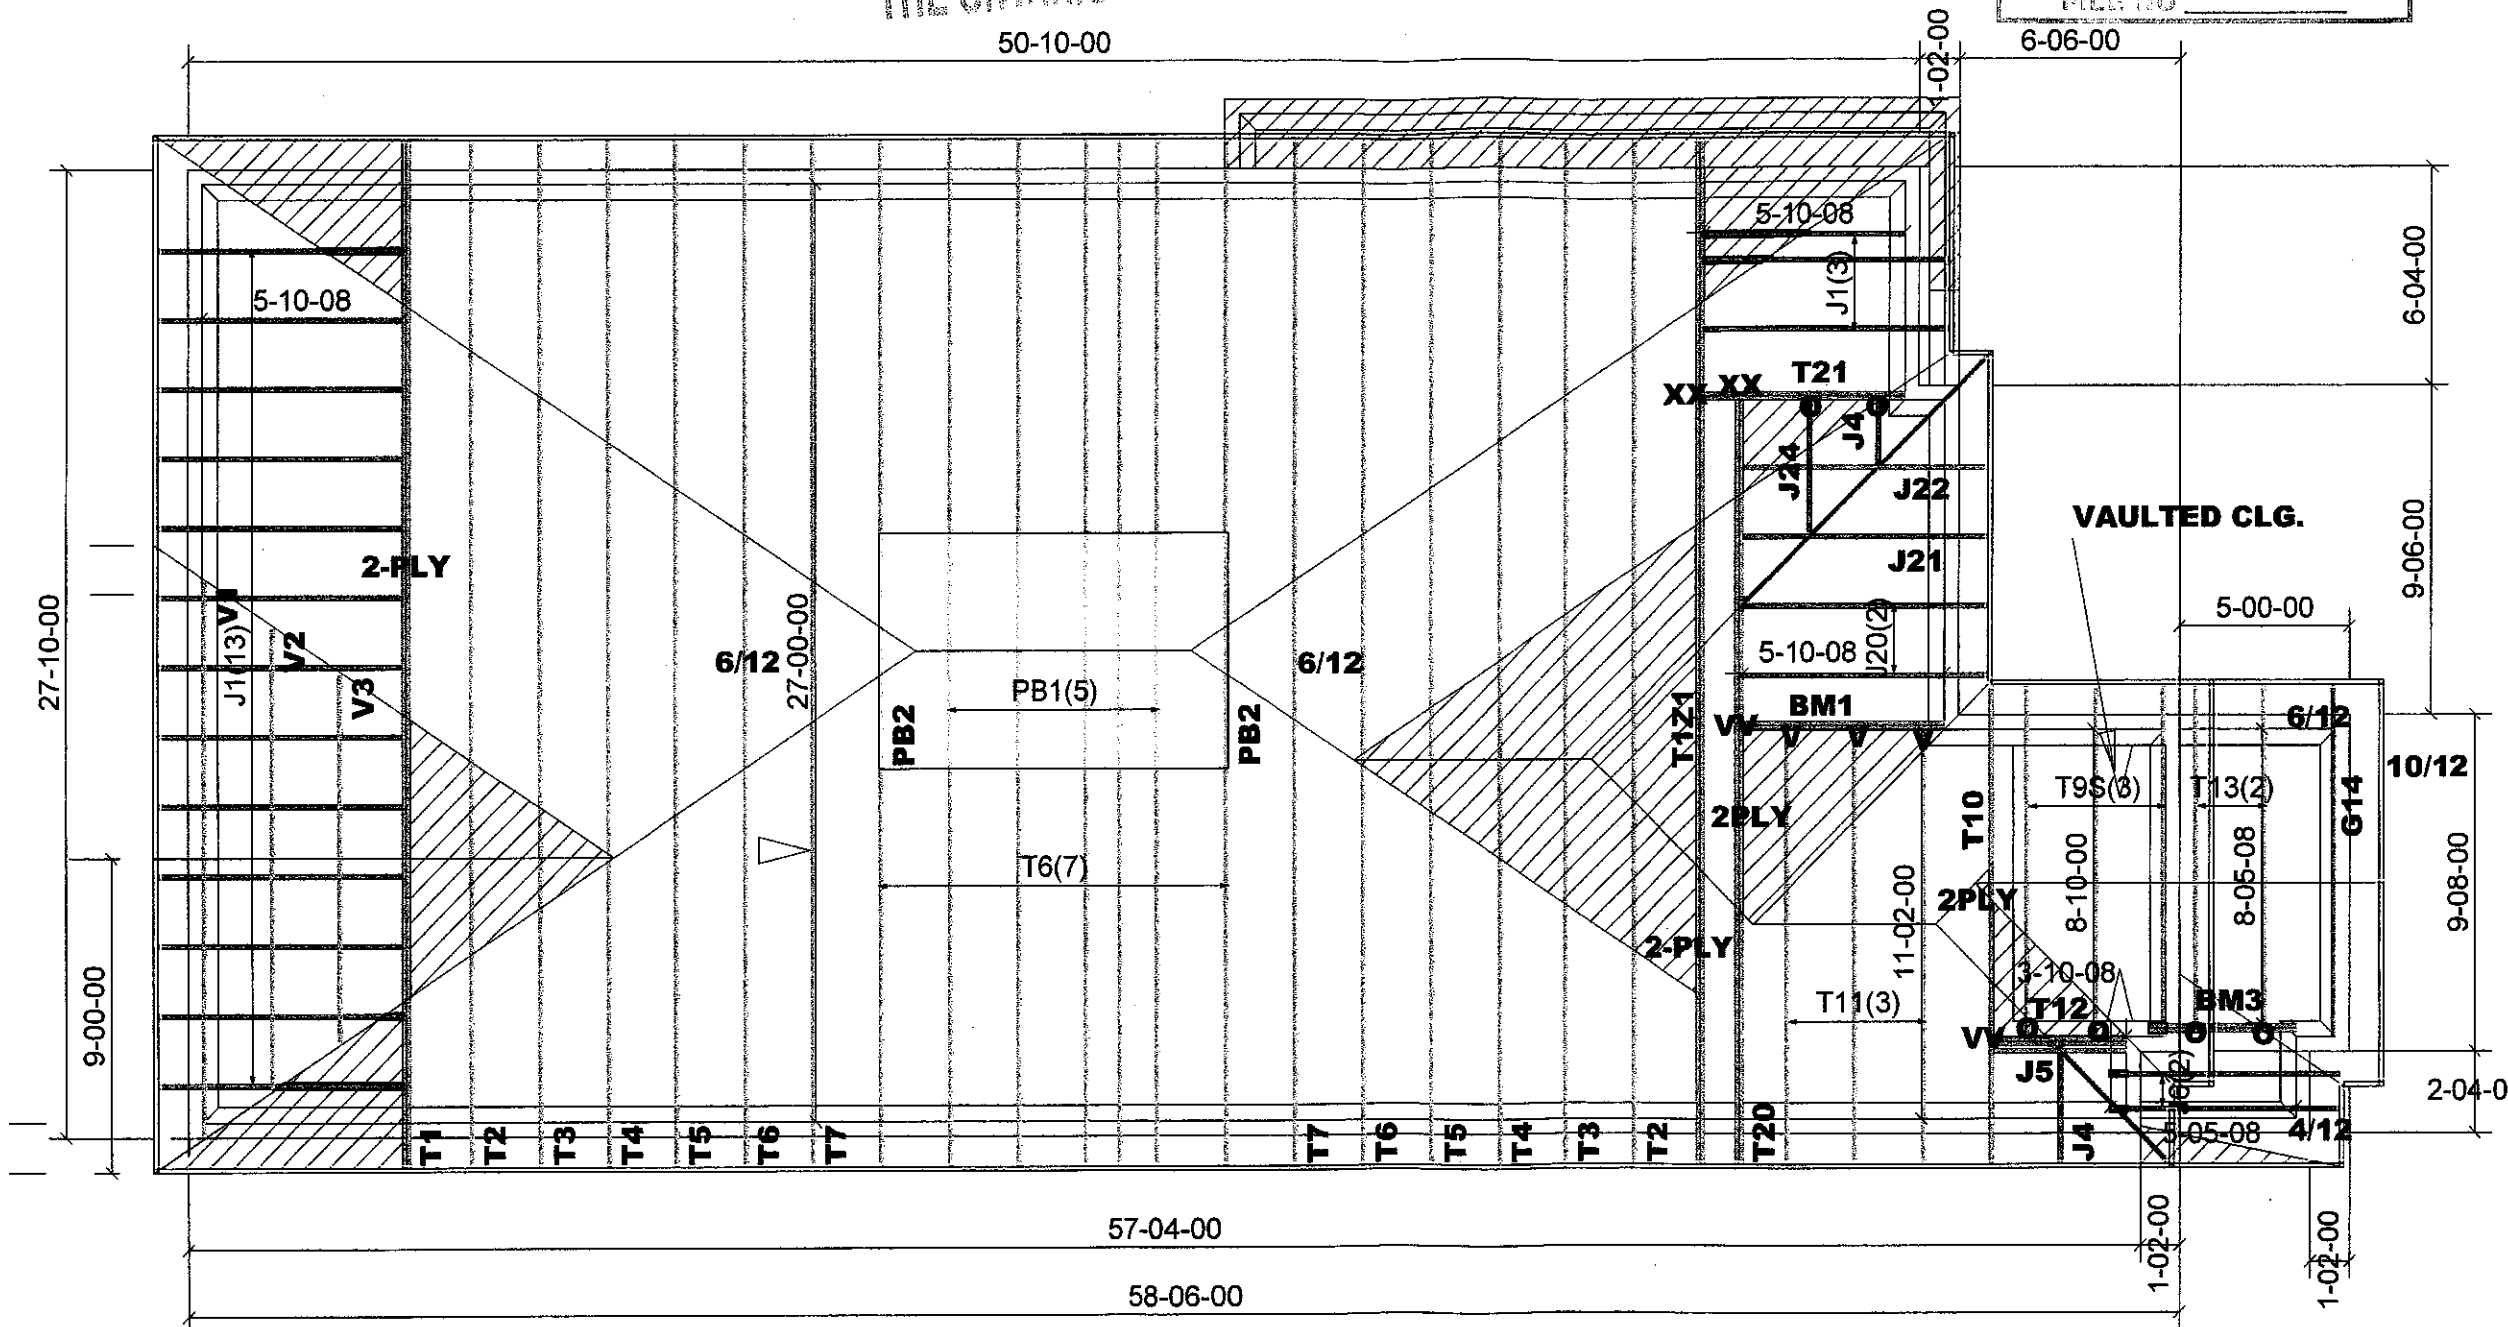

M12243



Job Track: **50033**
Plan Log: **201021**
Layout ID: **402981**

Builder / Location:
GREEN PARK HOMES / CALEDON
Project: **LAMBERT LANE PH.2**
Date: 5/7/2019 Sales: **Mario DiCano** Designer: **JG**

Model / Elevation:
BARTON 4/2- REAR UPGRADE

Misk ver 8.2.3.229

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.




DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: LAMBERT LANE PH.2
 Location: CALEDON
 Model: BARTON 4
 Lot #:
 Elevation: 2- REAR UPGRADE

Job Track: 50033
 PlanLog: 201021
 Layout ID: 402981
 Ref #
 Page: 1 of 3
 Date: 05/07/2019
 Designer: Jane Gong
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	9 /12	27-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-06-04 1-06-04	279.07 176.67		
	1 2-ply	T1Z1 Hip Girder	9 /12	27-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-06-04 1-06-04	254.79 164.67		
	2	T2 Hip	9 /12	27-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	221.33 142.00		
	2	T3 Hip	9 /12	27-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	242.71 157.33		
	2	T4 Hip	9 /12	27-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	245.08 159.00		
	2	T5 Hip	9 /12	27-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	259.05 166.67		
	9	T6 Hip	9 /12	27-00-00	9-01-04	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	1168.51 738.00		
	2	T7 Hip	9 /12	27-00-00	10-01-04	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	284.11 169.33		
	3	T9S Scissor	9 /12 6 /12	8-10-00	4-10-00	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	117.75 79.50		
	1	T10 Hip Girder	9 /12	11-02-00	4-05-02	2 x 4 2 x 6	1-05-00 1-03-08	1-06-04 1-06-04	59.88 37.33		
	3	T11 Common	9 /12	11-02-00	5-08-08	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	144.14 95.00		
	1 2-ply	T12 Jack-Closed Girder	9 /12	3-10-08	3-01-00	2 x 4 2 x 6		1-06-04 3-01-00	43.25 29.00		
	2	T13 Common	6 /12	8-05-08	3-02-03	2 x 4 2 x 6	1-03-08	6-12 9-00	61.74 40.67		
	1	G14 GABLE	6 /12	8-10-00	3-02-03	2 x 4	1-03-08 1-03-08	6-12 6-12	28.68 18.83		

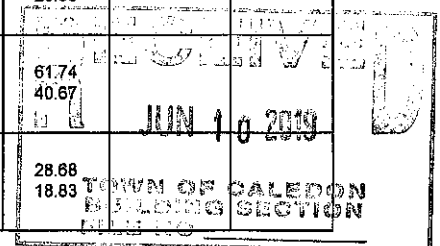



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: LAMBERT LANE PH.2
 Location: CALEDON
 Model: BARTON 4
 Lot #:
 Elevation: 2- REAR UPGRADE

Job Track: 50033
 PlanLog: 201021
 Layout ID: 402981
 Ref #
 Page: 2 of 3
 Date: 05/07/2019
 Designer: Jane Gong
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T20 Hip Girder	9/12	20-08-00	5-11-02	2 x 4 2 x 6	1-03-08 1-03-08	1-06-04 1-06-04	208.6 134.67		
	1 2-ply	T21 Jack-Closed Girder	6/12	5-10-08	4-01-04	2 x 4 2 x 6		1-02-00 4-01-04	58.52 37.67		
	5	PB1 Piggyback	9/12	6-09-05	2-06-08	2 x 4			79.19 53.33		
	2	PB2 Piggyback	9/12	6-09-05	2-00-00	2 x 4			35.06 25.33		
	1	V1 Valley	9/12	15-10-00	5-11-04	2 x 4			53.83 34.00		
	1	V2 Valley	9/12	13-02-00	4-11-04	2 x 4			36.04 22.50		
	1	V3 Valley	9/12	10-06-00	3-11-04	2 x 4			28.38 18.67		
	16	J1 Jack-Open	6/12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	268.71 170.67		
	2	J4 Jack-Open	9/12	1-09-07	2-10-05	2 x 4	1-03-08 1-01	1-06-04 2-10-05	18.63 14.00		
	1	J5 Jack-Open Girder	9/12	3-10-08	2-10-05	2 x 4		1-06-04 4-05-02	9.91 7.00		
	2	J6 GABLE	4/12	5-05-08	2-06-11	2 x 4	1-03-08	3-15 2-01-12	28.9 18.67		
	2	J20 Jack-Open	9/12	5-10-08	5-11-02	2 x 4	1-03-08	1-06-04 5-11-02	36.8 24.00		
	1	J21 Jack-Open	9/12	3-09-07	4-04-05	2 x 4	1-03-08 2-01-01	1-06-04 4-04-05	16.84 11.00		
	1	J22 Jack-Open Girder	9/12	1-09-07	2-10-05	2 x 4	1-03-08 4-01-01	1-06-04 2-10-05	14.15 9.67		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: LAMBERT LANE PH.2
 Location: CALEDON
 Model: BARTON 4
 Lot #:
 Elevation: 2- REAR UPGRADE

Job Track: 50033
 PlanLog: 201021
 Layout ID: 402981
 Ref #
 Page: 3 of 3
 Date: 05/07/2019
 Designer: Jane Gong
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	J24 Jack-Open	9 /12	1-10-08	4-04-05	2 x 4	1-10-15	1-06-04 2-11-02	10.38 7.00		


TOTAL # TRUSS= 75 TOTAL BFT OF ALL TRUSSES= 2762.18 BFT. TOTAL WEIGHT OF ALL TRSSES 4292.02 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
3	Hardware	LJS26DS	
6	Hardware	LUS24	
2	Hardware	LUS26-2	
2	Hardware	HGUS26-2	

TOTAL NUMBER OF ITEMS= 13

JOB NAME 402979	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

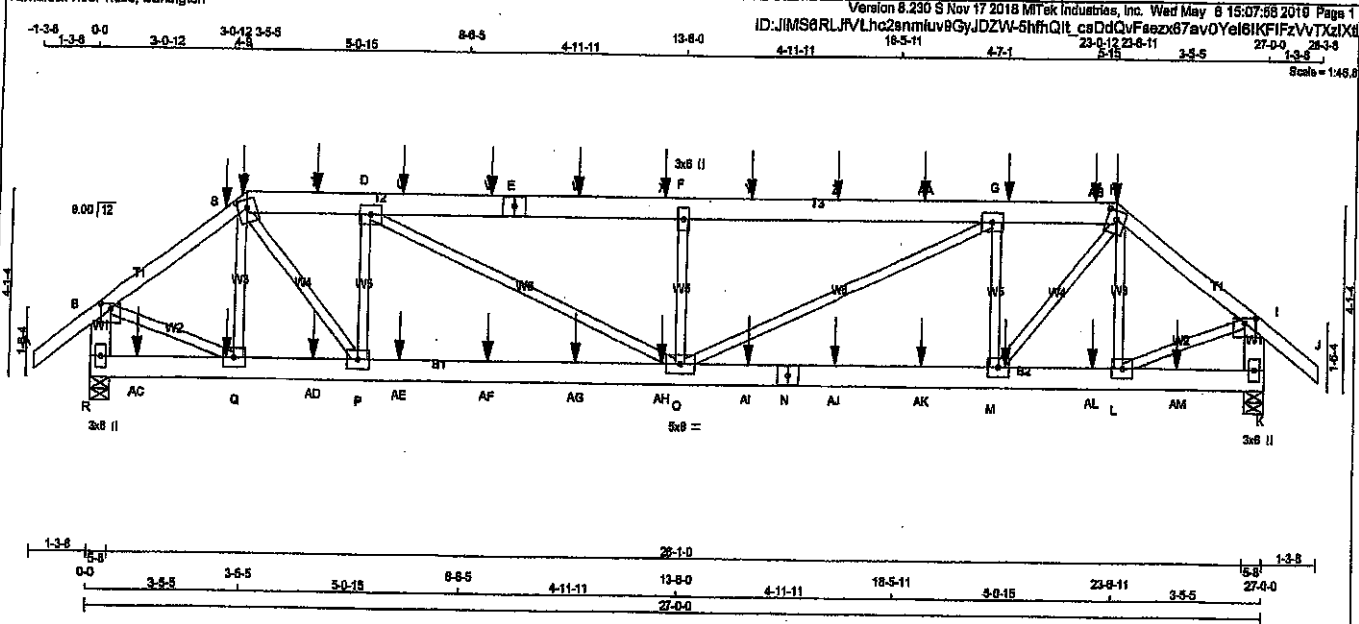

TOTAL WEIGHT = 2 X 140 = 279 lb

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
E - H	2x4	DRY No.2	SPF
H - J	2x4	DRY No.2	SPF
R - B	2x4	DRY No.2	SPF
K - I	2x4	DRY No.2	SPF
R - N	2x4	DRY No.2	SPF
N - K	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122'X3') SPIRAL NAILS		
A-C	12	SIDE (61.0)
H-J	12	SIDE (61.0)
C-E	12	SIDE (61.0)
E-H	12	SIDE (61.0)
R-B	12	TOP
K-I	12	TOP
BOTTOM CHORDS : (0.122'X3') SPIRAL NAILS		
R-N	12	SIDE (183.1)
N-K	12	SIDE (183.1)
WEBS : (0.122'X3') SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table in inches)	W	LEN	Y	X
BT TYPE				
B TMWW-p	MT20	5.0	6.0	1.25 3.00
C TTWW-m	MT20	5.0	6.0	2.25 2.50
D TMWW-t	MT20	5.0	6.0	
E TS-4	MT20	5.0	6.0	
F TMWW-w	MT20	3.0	6.0	
G TMWW-w	MT20	5.0	6.0	
H TTWW-m	MT20	5.0	6.0	2.25 2.50
I TMWW-p	MT20	5.0	6.0	1.25 3.00
K BMV-1p	MT20	3.0	6.0	
L M, P, Q				
L BMWW-t	MT20	5.0	6.0	
N BS-t	MT20	5.0	6.0	
O BMWW-t	MT20	5.0	6.0	
R BMV-1p	MT20	3.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQD
GROSS REACTION		GROSS REACTION		GROSS REACTION		BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-6X	IN-6X
R	3433	0	3433	0	0	5-8	5-8
K	3358	0	3358	0	0	5-8	5-8

UNFACTORED REACTIONS							
1ST LCASE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	2554	1447 / 0	485 / 0	0 / 0	0 / 0	622 / 0	0 / 0
K	2497	1417 / 0	472 / 0	0 / 0	0 / 0	608 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLINE SPACING = 4.46 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (LBS)	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
A-B	0 / 42	-102.1	-102.1	Q-C	-777 / 0
B-S	-3441 / 0	-102.1	-102.1	C-P	0 / 2841
S-C	-3441 / 0	-102.1	-102.1	P-D	-1865 / 0
C-T	-4624 / 0	-102.1	-102.1	D-O	0 / 1907
T-D	-4624 / 0	-102.1	-102.1	O-F	-1243 / 0
D-U	-8227 / 0	-102.1	-102.1	F-G	0 / 1927
U-V	-8227 / 0	-102.1	-102.1	G-H	-1889 / 0
V-E	-8227 / 0	-102.1	-102.1	H-M	0 / 2874
E-W	-8227 / 0	-102.1	-102.1	M-H	-774 / 0
W-X	-8227 / 0	-102.1	-102.1	H-L	0 / 2940
X-F	-8227 / 0	-102.1	-102.1	L-I	0 / 2800
F-Y	-8227 / 0	-102.1	-102.1		
Y-Z	-8227 / 0	-102.1	-102.1		
Z-AA	-8227 / 0	-102.1	-102.1		
AA-G	-8227 / 0	-102.1	-102.1		
G-AB	-4505 / 0	-102.1	-102.1		
AB-H	-4505 / 0	-102.1	-102.1		
H-I	-3429 / 0	-102.1	-102.1		
I-J	0 / 42	-102.1	-102.1		
R-B	-3334 / 0	0.0	0.0		
K-I	-3276 / 0	0.0	0.0		
R-AC	0 / 0	-38.5	-38.5		
AC-Q	0 / 0	-38.5	-38.5		
Q-AD	0 / 2813	-38.5	-38.5		
AD-P	0 / 2813	-38.5	-38.5		
P-AE	0 / 4522	-38.5	-38.5		
AE-AF	0 / 4522	-38.5	-38.5		
AF-AG	0 / 4522	-38.5	-38.5		
AG-AH	0 / 4522	-38.5	-38.5		
AH-O	0 / 4522	-38.5	-38.5		
O-AI	0 / 4504	-38.5	-38.5		
AI-N	0 / 4504	-38.5	-38.5		
N-AJ	0 / 4504	-38.5	-38.5		
AJ-AK	0 / 4504	-38.5	-38.5		
AK-M	0 / 4504	-38.5	-38.5		
M-AL	0 / 2774	-38.5	-38.5		
AL-L	0 / 2774	-38.5	-38.5		
L-AM	0 / 0	-38.5	-38.5		
AM-K	0 / 0	-38.5	-38.5		

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 29.1 PSF
DL = 8.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***
ADDTL. USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.80")
CALCULATED VERT. DEFL. (LL) = L/988 (0.11")
ALLOWABLE DEFL. (TL) = L/360 (0.80")
CALCULATED VERT. DEFL. (TL) = L/988 (0.19")

CSI: TC=0.34/1.00 (F-G:1), BC=0.39/1.00 (M-O:1)
WB=0.36/1.00 (B-Q:1), SS=0.22/1.00 (D-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN MAX MIN MAX MIN		
MT20	618 354 1987 788 1987 1656	

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.



JSI GRIP=0.85 (L) (INPUT = 0.80)
JSI METAL=0.49 (N) (INPUT = 1.00)

CONTINUED ON PAGE 2

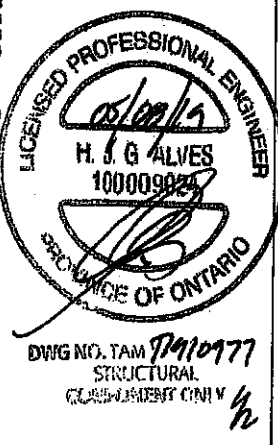


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
402879	T1	1	2	TRUSS DESC.		
Tamarack Roof Truss, Burlington				Version 8.230 8 Nov 17 2018 MiTek Industries, Inc. Wed May 8 15:07:58 2019 Page 2 ID:JIMS8RLJVLhc2anmluv9GyJDZVW-5hfhQK caDdQvFaezxx87av0YelB1KFIFzVVTXzIX8		

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LO1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	3-5-5	-44	-49	-	FRONT	VERT	DEAD	-	-
C	3-5-5	-251	-251	-	FRONT	VERT	SNOW	-	-
G	21-0-12	-123	-123	-	BACK	VERT	TOTAL	-	-
H	23-6-11	-44	-49	-	FRONT	VERT	DEAD	-	-
H	23-6-11	-251	-251	-	FRONT	VERT	SNOW	-	-
M	21-0-12	-55	-70	-	BACK	VERT	TOTAL	-	-
Q	3-0-12	-55	-70	-	BACK	VERT	TOTAL	-	-
S	3-0-12	-155	-155	-	BACK	VERT	TOTAL	-	-
T	5-0-12	-123	-123	-	BACK	VERT	TOTAL	-	-
U	7-0-12	-123	-123	-	BACK	VERT	TOTAL	-	-
V	9-0-12	-123	-123	-	BACK	VERT	TOTAL	-	-
W	11-0-12	-123	-123	-	BACK	VERT	TOTAL	-	-
X	13-0-12	-123	-123	-	BACK	VERT	TOTAL	-	-
Y	15-0-12	-123	-123	-	BACK	VERT	TOTAL	-	-
Z	17-0-12	-123	-123	-	BACK	VERT	TOTAL	-	-
AA	19-0-12	-123	-123	-	BACK	VERT	TOTAL	-	-
AB	23-0-12	-149	-149	-	BACK	VERT	TOTAL	-	-
AC	1-0-12	-55	-70	-	BACK	VERT	TOTAL	-	-
AD	5-0-12	-55	-70	-	BACK	VERT	TOTAL	-	-
AE	7-0-12	-55	-70	-	BACK	VERT	TOTAL	-	-
AF	9-0-12	-55	-70	-	BACK	VERT	TOTAL	-	-
AG	11-0-12	-55	-70	-	BACK	VERT	TOTAL	-	-
AH	13-0-12	-55	-70	-	BACK	VERT	TOTAL	-	-
AI	15-0-12	-55	-70	-	BACK	VERT	TOTAL	-	-
AJ	17-0-12	-55	-70	-	BACK	VERT	TOTAL	-	-
AK	19-0-12	-55	-70	-	BACK	VERT	TOTAL	-	-
AL	23-0-12	-55	-70	-	BACK	VERT	TOTAL	-	-
AM	25-0-12	-55	-70	-	BACK	VERT	TOTAL	-	-

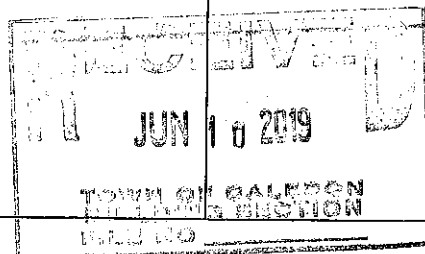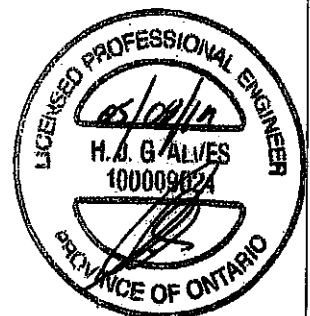

DWG NO. TAM 174/0977
STRUCTURAL
COMPONENT ONLY 7/2

JOB NAME 402981	TRUSS NAME T1Z1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.230 5 Nov 17 2018 Mitek Industries, Inc. Wed May 8 15:15:38 2019 Page 1	
ID: JIMS6RLJVLhc2smmluv9GyJDZw-dASazbRXHCAMccQGaaB_mbyW53GR4KL71XxEctzlXmZ				22-5-12 23-6-11 27-0-0 28-3-8	
1-3-8 0-0 3-5-5 3-5-5 5-0-15 8-8-5 4-11-11 13-6-0 4-11-11 18-5-11 4-3-1 0-15 3-5-5 27-0-0 1-3-8				Scale = 1/4" = 1'-0"	

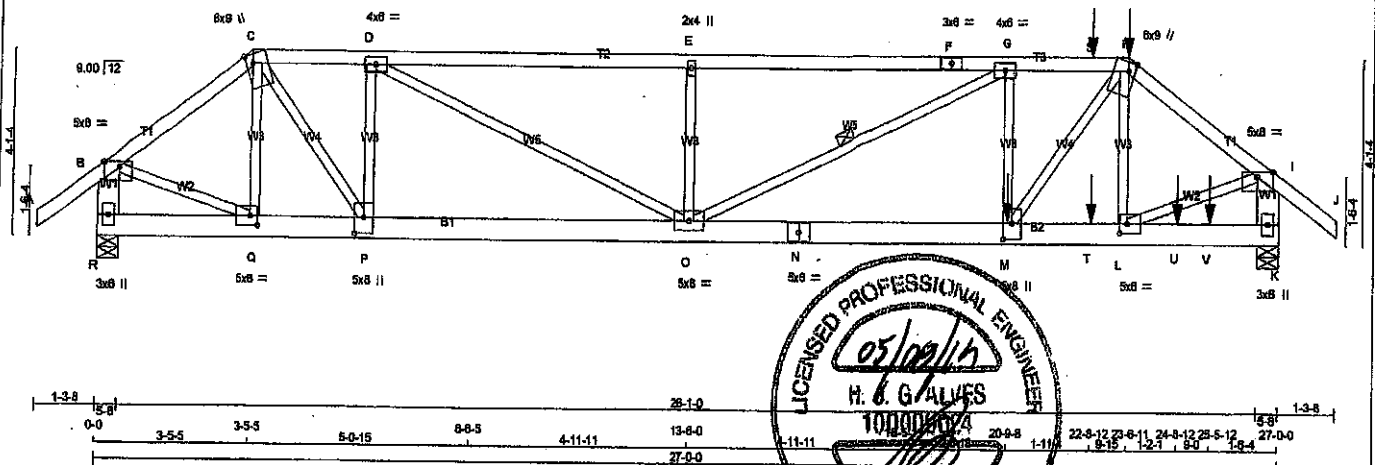

TOTAL WEIGHT = 2 X 127 = 255 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
R - B	2x8	DRY	No.2	SPF	
K - I	2x8	DRY	No.2	SPF	
R - N	2x8	DRY	No.2	SPF	
N - K	2x8	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C 1 12	TOP	
C-F 1 12	TOP	
F-H 1 12	TOP	
H-J 1 12	TOP	
R-B 2 12	TOP	
K-I 2 12	TOP	
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
R-N 2 12	TOP	
N-K 2 12	TOP	
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1 6		
G-M 1 3	SIDE(598.9)	
D-P 1 3	SIDE(598.9)	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW+m	MT20	6.0	9.0	Edge 2.00	
D	TMVW-i	MT20	4.0	6.0		
E	TMVW-w	MT20	2.0	4.0		
F	TS-i	MT20	3.0	8.0		
G	TMVW-i	MT20	4.0	6.0		
H	TTWW+m	MT20	6.0	9.0	Edge 2.00	
I	TMVW-p	MT20	5.0	8.0	Edge	
K	BMV1+p	MT20	3.0	8.0		
L	BMVW-i	MT20	5.0	8.0	2.50 2.00	
M	BMVW-i	MT20	5.0	8.0	4.25 2.50	
N	BS-i	MT20	5.0	8.0		
O	BMVW-w	MT20	5.0	8.0		
P	BMVW-w	MT20	5.0	8.0	4.25 2.50	
Q	BMVW-i	MT20	5.0	8.0	2.50 2.00	
R	BMV1+p	MT20	3.0	8.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR ARE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	UP	IN-SX
R	2803	0	0	5-8
K	4884	0	0	5-8

UNFACTORED REACTIONS

1ST LOASE	MAX/MIN COMPONENT REACTIONS	1ST LOASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	R	COMBINED
R	2076	R	1209 / 0
K	3598	K	2101 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.34 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO		
A-B	0 / 42	-102.1 -102.1	0.08 (1)	Q-C	-819 / 0	0.08 (1)
B-C	-2848 / 0	-102.1 -102.1	0.15 (1)	C-P	0 / 2834	0.33 (1)
C-D	-3828 / 0	-102.1 -102.1	0.31 (1)	P-D	-1874 / 0	0.24 (1)
D-E	-8341 / 0	-102.1 -102.1	0.81 (1)	D-O	0 / 2822	0.35 (1)
E-F	-8341 / 0	-102.1 -102.1	0.81 (1)	O-E	-787 / 0	0.10 (1)
F-G	-8341 / 0	-102.1 -102.1	0.81 (1)	G-O	-464 / 0	0.11 (1)
G-S	-8754 / 0	-102.1 -102.1	0.40 (1)	M-G	-384 / 0	0.05 (1)
S-H	-8754 / 0	-102.1 -102.1	0.40 (1)	M-H	0 / 4364	0.54 (1)
H-I	-5232 / 0	-102.1 -102.1	0.23 (1)	L-H	-985 / 0	0.12 (1)
I-J	0 / 42	-102.1 -102.1	0.08 (1)	B-Q	0 / 2381	0.29 (1)
R-B	-2744 / 0	0.0 0.0	0.10 (1)	L-I	0 / 4375	0.54 (1)
K-I	-4778 / 0	0.0 0.0	0.17 (1)			
R-Q	0 / 0	-38.5 -38.5	0.02 (3)			
Q-P	0 / 2256	-38.5 -38.5	0.19 (1)			
P-O	0 / 3829	-38.5 -38.5	0.31 (1)			
O-N	0 / 6754	-38.5 -38.5	0.54 (1)			
N-M	0 / 6754	-38.5 -38.5	0.54 (1)			
M-T	0 / 4148	-38.5 -38.5	0.31 (1)			
T-L	0 / 4148	-38.5 -38.5	0.31 (1)			
L-U	0 / 0	-38.5 -38.5	0.05 (3)			
U-V	0 / 0	-38.5 -38.5	0.05 (3)			
V-K	0 / 0	-38.5 -38.5	0.05 (3)			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
H	23-8-11	-44	-49	-	FRONT	VERT	DEAD	-	-
H	23-8-11	-251	-251	-	FRONT	VERT	SNOW	-	-
M	20-9-8	-2988	-2988	-	FRONT	VERT	TOTAL	-	-
S	22-8-12	-132	-132	-	FRONT	VERT	TOTAL	-	-
T	22-8-12	-55	-70	-	FRONT	VERT	TOTAL	-	-
U	24-8-12	-55	-70	-	FRONT	VERT	TOTAL	-	-
V	25-5-12	-55	-70	-	FRONT	VERT	TOTAL	-	-

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	=	29.1 PSF
DL	=	6.0 PSF	
BOT CH.	LL	=	10.5 PSF
DL	=	7.0 PSF	
TOTAL LOAD	=	52.5 PSF	

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.90")
CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (0.90")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.81/1.00 (E-G:1), BC=0.54/1.00 (M-O:1)
WB=0.54/1.00 (L-I:1), SI=0.17/1.00 (E-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MT20	618 354 1887 788 1887 1658	

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (H) (INPUT = 0.90)
JSI METAL = 0.88 (N) (INPUT = 1.00)

JOB NAME 402938	TRUSS NAME T2	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.230 8 Nov 17 2018 Mitek Industries, Inc. Tue May 7 17:41:40 2018 Page 1
ID:VdmZNIanRCr_yT1p7QGzKFlu-qvGDS7ax8wb1J8tSCJb9JQmVjWdM8zNCb3_fuzqj

1-3-8 0-0 4-8-5 4-8-5 5-10-3 10-7-8 5-8-15 16-4-8 5-10-3 22-3-11 4-8-5 27-0-0 1-3-8
Scale = 1/16.8

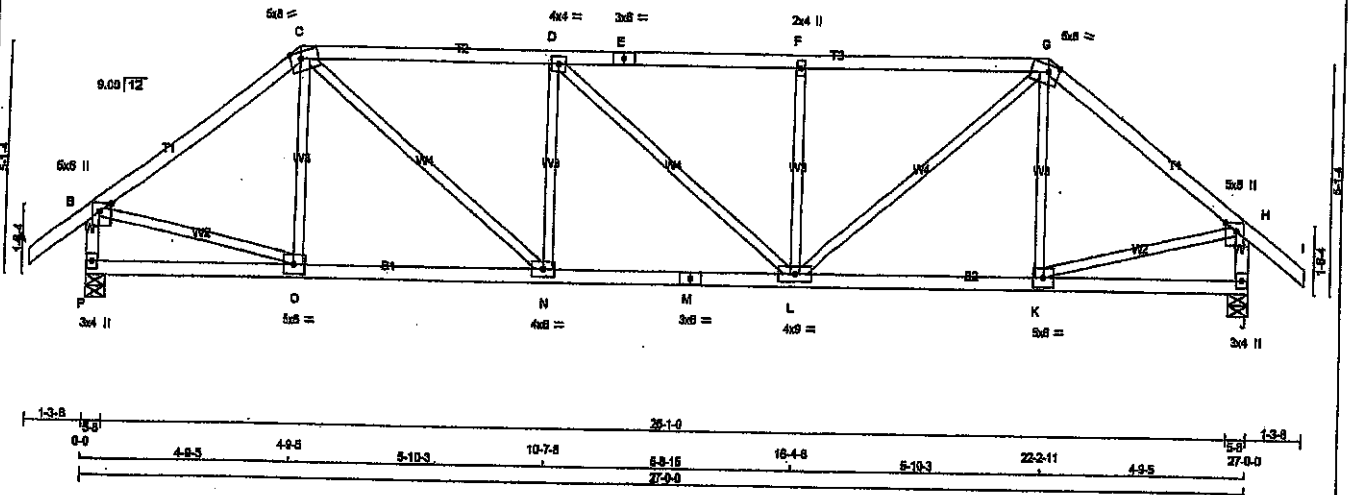

TOTAL WEIGHT = 2 X 111 = 221 lb

LUMBER	N.L. & A. RULES	SIZE	LUMBER	DESCR.
CHORDS				
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
I - K	2x4	DRY	No.2	SPF
K - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS	2x4	DRY	No.2	SPF
EXCEPT				
DRY: SEASONED LUMBER.				

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG					
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
P	2039	0	2039	0	0	5-8	5-8		
J	2039	0	2039	0	0	5-8	5-8		
UNFACTORED REACTIONS									
1ST LCASE	MAX/MIN COMPONENT REACTIONS								
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
P	1515	864 / 0	284 / 0	0 / 0	0 / 0	388 / 0	0 / 0		
J	1515	864 / 0	284 / 0	0 / 0	0 / 0	388 / 0	0 / 0		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.1 PSF
DL = 8.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 37.5 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = 1/380 (0.80")
CALCULATED VERT. DEFL. (LL) = 1/999 (0.12")
ALLOWABLE DEFL. (TL) = 1/380 (0.80")
CALCULATED VERT. DEFL. (TL) = 1/669 (0.20")

CSI: TC=0.88/1.00 (C-D:1), BC=0.55/1.00 (L-N:1), WB=0.37/1.00 (H-K:1), SS=0.28/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	5.0	8.0	Edge 3.00
C	TTWW+m	MT20	5.0	8.0	1.75 3.00
D	TMVW-l	MT20	4.0	4.0	
E	TS-t	MT20	3.0	6.0	
F	TMVW-w	MT20	2.0	4.0	
G	TTWW-m	MT20	5.0	8.0	1.75 3.00
H	TMVW+p	MT20	5.0	8.0	Edge 3.00
J	BMVW+p	MT20	3.0	4.0	
K	BMVW-l	MT20	5.0	8.0	
L	BMVW-w	MT20	4.0	8.0	
M	BS-t	MT20	3.0	6.0	
N	BMVW-l	MT20	4.0	8.0	
O	BMVW-t	MT20	5.0	8.0	
P	BMVW+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J									
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.69 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.									
LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)		
FR-TO		FROM TO			FR-TO				
A-B	0 / 42	-102.1 -102.1	0.14 (1)	10.00	C-C	-169 / 110	0.08 (1)		
B-C	-1885 / 0	-102.1 -102.1	0.32 (1)	4.22	C-N	0 / 1355	0.30 (1)		
C-D	-2830 / 0	-102.1 -102.1	0.08 (1)	3.59	N-D	-840 / 0	0.25 (1)		
D-E	-2828 / 0	-102.1 -102.1	0.65 (1)	3.59	D-L	-2 / 0	0.00 (1)		
E-F	-2828 / 0	-102.1 -102.1	0.65 (1)	3.59	L-F	-639 / 0	0.25 (1)		
F-G	-2828 / 0	-102.1 -102.1	0.65 (1)	3.81	L-G	0 / 1353	0.30 (1)		
G-H	-1885 / 0	-102.1 -102.1	0.32 (1)	4.22	K-G	-157 / 110	0.08 (1)		
H-I	0 / 42	-102.1 -102.1	0.14 (1)	10.00	B-O	0 / 1632	0.37 (1)		
P-B	-1887 / 0	0.0 0.0	0.21 (1)	8.00	K-H	0 / 1632	0.37 (1)		
J-H	-1957 / 0	0.0 0.0	0.21 (1)	8.00					
P-O	0 / 0	-38.5 -38.5	0.20 (3)	10.00					
O-N	0 / 1682	-38.5 -38.5	0.41 (2)	10.00					
N-M	0 / 2830	-38.5 -38.5	0.55 (1)	10.00					
M-L	0 / 2830	-38.5 -38.5	0.55 (1)	10.00					
L-K	0 / 1682	-38.5 -38.5	0.41 (2)	10.00					
K-J	0 / 0	-38.5 -38.5	0.20 (3)	10.00					

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 37.5 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = 1/380 (0.80")
CALCULATED VERT. DEFL. (LL) = 1/999 (0.12")
ALLOWABLE DEFL. (TL) = 1/380 (0.80")
CALCULATED VERT. DEFL. (TL) = 1/669 (0.20")

CSI: TC=0.88/1.00 (C-D:1), BC=0.55/1.00 (L-N:1), WB=0.37/1.00 (H-K:1), SS=0.28/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10


COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1695

PLATE PLACEMENT TOL = 0.250 inches
PLATE ROTATION TOL = 5.0 Deg.
GRIP = 0.88 (G) (INPUT = 0.90)
METAL = 0.91 (M) (INPUT = 1.00)

THIS STRUCTURE MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE PROVISIONS OF
THE ONTARIO BUILDING CODE

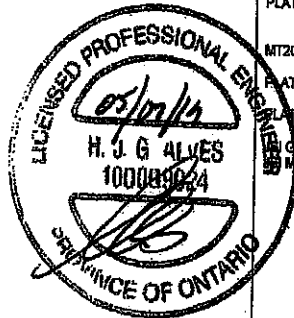


DRWG NO. TAM 19/0761
STRUCTURAL
CONCRETE ONLY

JOB NAME 402938	TRUSS NAME T3	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Tue May 7 17:41:41 2018 Page 1

ID:VdmZnlanRCr_yT1tp7OGfzKFlu-15pbtpZuDJ9wSk30wqghVz7w7W5VBWRfoXBKz1qle



LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
J - K	2x4	DRY	No.2
K - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
C	TMVW+4	MT20	5.0	8.0 2.50 2.60
D	TTWV+m	MT20	5.0	8.0 1.75 2.60
E	TMVW+4	MT20	4.0	4.0
F	TMVW+w	MT20	2.0	4.0
G	TTWV+m	MT20	5.0	8.0 1.75 2.60
H	TMVW+4	MT20	5.0	8.0 2.50 2.50
I	TMV+p	MT20	3.0	4.0
K	BMVW+4	MT20	5.0	8.0 2.50 2.75
L	BMVW+4	MT20	4.0	4.0
M	BMVWV+4	MT20	4.0	9.0
N	BS-4	MT20	3.0	8.0
O	BMVW+4	MT20	4.0	8.0
P	BMVW+4	MT20	4.0	4.0
Q	BMVW+4	MT20	5.0	8.0 2.50 2.75

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED	MAXIMUM FACTORED	INPUT	RECORD	
	GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	UPLIFT	IN-SX
Q	2039	0	2039	0	5-8
K	2039	0	2039	0	5-8

UNFACTORED REACTIONS						
	1ST CASE	MAX/MIN	COMPONENT REACTIONS			
JT	COMBINED	SNOW	LIVE	PERMILIVE	WIND	DEAD
Q	1515	864/0	284/0	0/0	0/0	388/0
K	1515	864/0	284/0	0/0	0/0	388/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.17 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL FITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
A-B	0/42	-102.1 -102.1 0.14 (1)	10.00	C-P	0/178	0.04 (2)	
B-C	0/18	-102.1 -102.1 0.13 (1)	10.00	P-D	0/205	0.06 (3)	
C-D	-1988/0	-102.1 -102.1 0.18 (1)	4.64	D-O	0/935	0.21 (1)	
D-E	-2184/0	-102.1 -102.1 0.42 (1)	4.17	O-E	-540/0	0.32 (1)	
E-F	-2182/0	-102.1 -102.1 0.42 (1)	4.17	E-M	-3/0	0.00 (1)	
F-G	-2182/0	-102.1 -102.1 0.42 (1)	4.18	M-F	-539/0	0.32 (1)	
G-H	-1988/0	-102.1 -102.1 0.18 (1)	4.63	M-G	0/935	0.21 (1)	
H-I	0/18	-102.1 -102.1 0.13 (1)	10.00	L-G	0/205	0.06 (3)	
I-J	0/42	-102.1 -102.1 0.14 (1)	10.00	L-H	0/178	0.04 (2)	
Q-B	-286/0	0.0 0.0 0.03 (1)	7.81	Q-C	-2228/0	0.75 (1)	
K-I	-286/0	0.0 0.0 0.03 (1)	7.81	H-K	-2228/0	0.75 (1)	
Q-P	0/1466	-38.5 -38.5 0.43 (2)	10.00				
P-O	0/1574	-38.5 -38.5 0.45 (2)	10.00				
O-N	0/2184	-38.5 -38.5 0.43 (1)	10.00				
N-M	0/2184	-38.5 -38.5 0.43 (1)	10.00				
M-L	0/1574	-38.5 -38.5 0.46 (2)	10.00				
L-K	0/1466	-38.5 -38.5 0.44 (2)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.1 PSF
DL = 8.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2010, CBC 2012
- CSA 086-06, CSA 089-14
- TPIC 2011, TPIC 2014

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.90")
CALCULATED VERT. DEFL. (LL) = 1/989 (0.09")
ALLOWABLE DEFL. (TL) = L/360 (0.90")
CALCULATED VERT. DEFL. (TL) = 1/999 (0.15")

CSI: TC=0.42/1.00 (D-E=1), BC=0.46/1.00 (L-M=2), WB=0.75/1.00 (H-K=1), GS=0.23/1.00 (D-E=1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 619 354 1687 798 1987 1689

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

ISI GRIP=0.87 (K) (INPUT = 0.80)
ISI METAL=0.87 (K) (INPUT = 1.00)

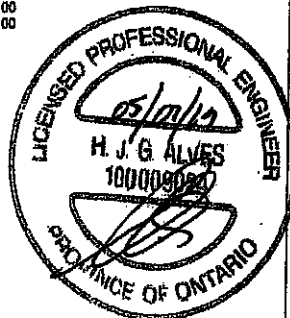


DRWG NO. TAM T910762
STRUCTURAL
COMPONENT ONLY

JOB NAME 402938	TRUSS NAME T4	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Tue May 7 17:41:42 2019 Page 1
ID:VdmZNIanRCr_yT1tp?OGrtzkFlu-nHNzt9uBDQ?YoJFadL3EKV8aXBdqYfVY5jrmz/qjd

1-3-8 0-0 3-9-15 3-9-15 3-7-7 7-5-5 5-0-11 13-4-0 5-0-11 18-6-11 23-2-1 3-9-15 27-4-0 28-3-8
Scale = 1:48.8

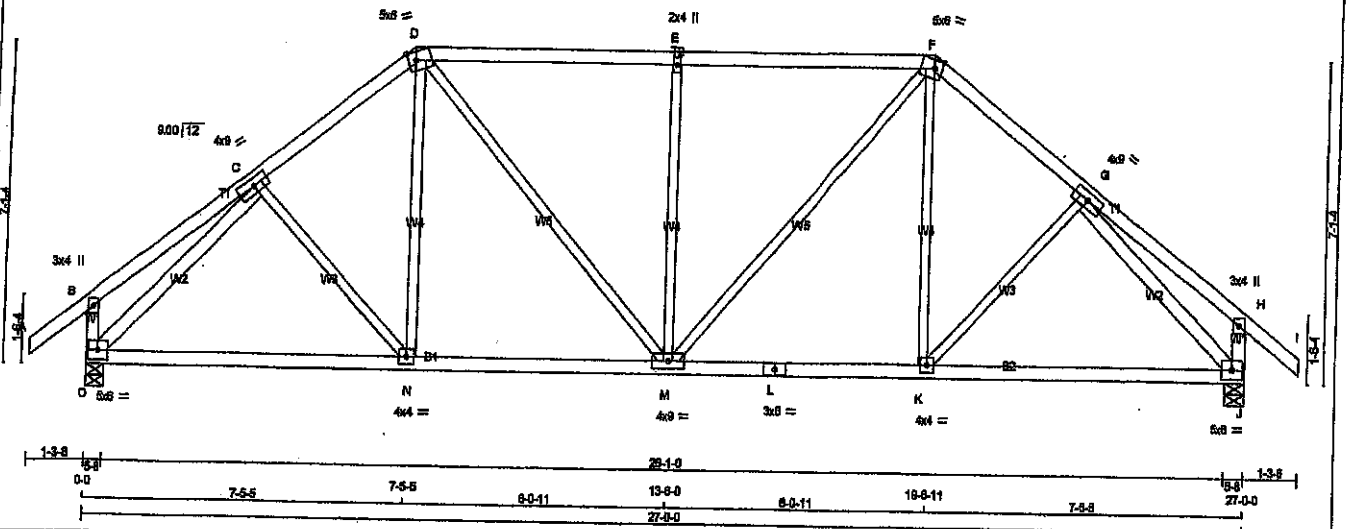

TOTAL WEIGHT = 2 X 123 = 246 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
O - B	2x4	DRY	No.2
J - O	2x4	DRY	No.2
L - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
O - C	2x4	DRY	No.2
G - J	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMVp	MT20	3.0	4.0
C	TMWw-t	MT20	4.0	8.0
D	TTWw-m	MT20	5.0	8.0 Edge 2.00
E	TTWw-w	MT20	2.0	4.0
F	TTWw-m	MT20	5.0	8.0 Edge 2.00
G	TMWw-t	MT20	4.0	8.0
H	TMVp	MT20	3.0	4.0
J	BMVW-t	MT20	5.0	8.0
K	BMVW-t	MT20	4.0	4.0
L	BS-t	MT20	3.0	8.0
M	BMVW-t	MT20	4.0	8.0
N	BMVW-t	MT20	4.0	4.0
O	BMVW-t	MT20	5.0	8.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED			MAXIMUM FACTORED			INPUT	RECORD
GROSS REACTION			GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
O	2039	0	2039	0	0	5-8	5-8
J	2039	0	2039	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST CASE MAX/MIN COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
O	1515	884 / 0	284 / 0	0 / 0	0 / 0	388 / 0	0 / 0
J	1515	884 / 0	284 / 0	0 / 0	0 / 0	388 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 / 42	-102.1	-102.1 0.14 (1)	10.00	C-N	0 / 113	0.03 (3)
B-C	0 / 25	-102.1	-102.1 0.22 (1)	10.00	N-D	0 / 351	0.08 (2)
C-D	-1948 / 0	-102.1	-102.1 0.21 (1)	4.65	D-M	0 / 828	0.14 (1)
D-E	-1955 / 0	-102.1	-102.1 0.54 (1)	4.20	M-E	-756 / 0	0.66 (1)
E-F	-1955 / 0	-102.1	-102.1 0.54 (1)	4.20	M-F	0 / 828	0.14 (1)
F-G	-1948 / 0	-102.1	-102.1 0.21 (1)	4.65	K-F	0 / 351	0.08 (2)
G-H	0 / 25	-102.1	-102.1 0.22 (1)	10.00	K-G	0 / 113	0.03 (3)
H-I	0 / 42	-102.1	-102.1 0.14 (1)	10.00	C-C	-2234 / 0	0.78 (1)
O-B	-288 / 0	0.0	0.0 0.03 (1)	7.81	G-J	-2234 / 0	0.76 (1)
J-H	-288 / 0	0.0	0.0 0.03 (1)	7.81			
O-N	0 / 1524	-38.5	-38.5 0.57 (2)	10.00			
N-M	0 / 1539	-38.5	-38.5 0.58 (2)	10.00			
M-L	0 / 1539	-38.5	-38.5 0.58 (2)	10.00			
L-K	0 / 1539	-38.5	-38.5 0.58 (2)	10.00			
K-J	0 / 1524	-38.5	-38.5 0.57 (2)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 28.1 PSF
DL = 8.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012
- CSA S88-08, CSA S88-14
- TPIC 2011, TPIC 2014

(58 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.80")
CALCULATED VERT. DEFL.(LL) = 1 / 999 (0.13")
ALLOWABLE DEFL.(TL) = L/360 (0.80")
CALCULATED VERT. DEFL.(TL) = 1 / 999 (0.22")

CS1 TO 0.54/1.00 (D-E-1), 50=0.58/1.00 (K-M-2), WS=0.78/1.00 (G-J-1), 85=0.30/1.00 (E-F-1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10. COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	
MAX	MIN	MAX	MIN
MT20	518	354	1957 788 1957 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JT GRIP= 0.89 (C) (INPUT = 0.90)
JH METAL = 0.68 (L) (INPUT = 1.00)

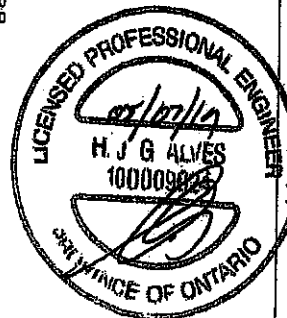

DRWG NO. TAM T410763
STRUCTURAL
ELEMENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
402938	T5	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.230 8 Nov 17 2018 Mittek Industries, Inc. Tue May 7 17:41:42 2018 Page 1
 ID:VdmZNIanRCr_vT1tp7OGfzKFlu-nHNz19uBfG?YcJFadL3EkVCfKfHfVY5jnz1qjd
 1-3-8 0-0 4-5-15 4-5-15 4-3-7 8-9-5 4-5-11 13-6-0 4-5-11 4-3-7 22-8-1 4-5-15 27-0-0 28-3-8
 1-3-8 0-0 4-5-15 4-3-7 8-9-5 4-5-11 13-6-0 4-5-11 18-2-11 4-3-7 22-8-1 4-5-15 27-0-0
 Scale: 1/4"=1'

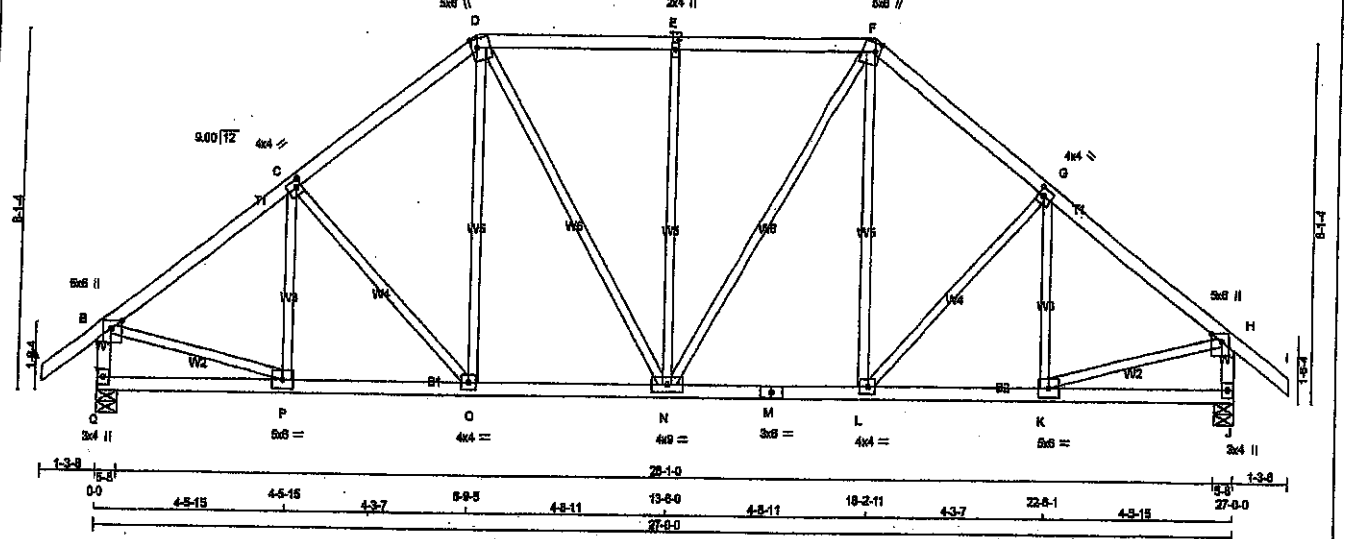

TOTAL WEIGHT = 2 X 130 = 259 lb

LUMBER	N. L. G. A. RULES	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
J - B	2x4	DRY	No.2	SPF
Q - H	2x4	DRY	No.2	SPF
Q - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS	2x6	DRY	No.2	SPF
EXCEPT				
DRY: SEASONED LUMBER.				

PLATES (table in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW+p	MT20	5.0	6.0	Edge	3.00	
C	TMWW-t	MT20	4.0	4.0	2.00	1.50	
D	TTWW+m	MT20	5.0	6.0	2.25	1.50	
E	TMWW-w	MT20	2.0	4.0			
F	TTWW+m	MT20	5.0	6.0	2.25	1.50	
G	TMWW-t	MT20	4.0	4.0	2.00	1.50	
H	TMWW+p	MT20	5.0	6.0	Edge	3.00	
J	BMV1+p	MT20	3.0	4.0			
K	BMWW-t	MT20	5.0	6.0			
L	BMWW-t	MT20	4.0	4.0			
M	BS-t	MT20	3.0	6.0			
N	BMWW-t	MT20	4.0	4.0			
O	BMWW-t	MT20	4.0	4.0			
P	BMWW-t	MT20	5.0	6.0			
Q	BMV1+p	MT20	3.0	4.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
	VERT	DOWN	IN-SK	IN-SK
JT	2039	0	5-8	5-8
Q	2039	0	5-8	5-8
J	2039	0	5-8	5-8

UNFACTORED REACTIONS	1ST LOASE	MAX/MIN COMPONENT REACTIONS
	COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
JT	1915	884 / 0 284 / 0 0 / 0 0 / 0 368 / 0 0 / 0
Q	1915	884 / 0 284 / 0 0 / 0 0 / 0 368 / 0 0 / 0
J	1915	884 / 0 284 / 0 0 / 0 0 / 0 368 / 0 0 / 0


BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.51 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (L)	MAX. UNBRACED LENGTH (L)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (L)
FR-TO						FR-TO			
A-B	0 / 42	-102.1	-102.1	0.14 (1)	10.00	P-C	-248 / 47	0.09 (1)	
B-C	-1997 / 0	-102.1	-102.1	0.30 (1)	4.81	C-O	-252 / 0	0.18 (1)	
C-D	-1845 / 0	-102.1	-102.1	0.29 (1)	4.88	O-D	0 / 370	0.08 (2)	
D-E	-1683 / 0	-102.1	-102.1	0.32 (1)	4.79	D-N	0 / 448	0.10 (1)	
E-F	-1683 / 0	-102.1	-102.1	0.32 (1)	4.79	N-E	-583 / 0	0.74 (1)	
F-G	-1845 / 0	-102.1	-102.1	0.29 (1)	4.88	N-F	0 / 448	0.10 (1)	
G-H	-1997 / 0	-102.1	-102.1	0.30 (1)	4.51	L-F	0 / 370	0.08 (2)	
H-I	0 / 42	-102.1	-102.1	0.14 (1)	10.00	L-G	-252 / 0	0.18 (1)	
Q-B	-1997 / 0	0.0	0.0	0.21 (1)	8.01	K-G	-248 / 47	0.09 (1)	
J-H	-1997 / 0	0.0	0.0	0.21 (1)	8.01	B-P	0 / 1678	0.38 (1)	
						K-H	0 / 1678	0.38 (1)	
Q-P	0 / 0	-38.5	-38.5	0.13 (3)	10.00				
P-O	0 / 1622	-38.5	-38.5	0.34 (1)	10.00				
O-N	0 / 1452	-38.5	-38.5	0.32 (1)	10.00				
N-M	0 / 1452	-38.5	-38.5	0.32 (1)	10.00				
M-L	0 / 1452	-38.5	-38.5	0.32 (1)	10.00				
L-K	0 / 1622	-38.5	-38.5	0.34 (1)	10.00				
K-J	0 / 0	-38.5	-38.5	0.13 (3)	10.00				

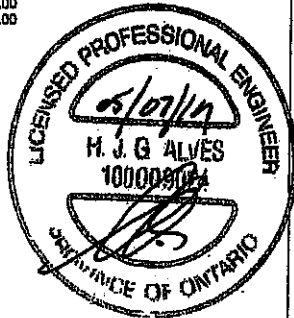

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 29.1 PSF
 DL = 8.0 PSF
 BOT CH. LL = 10.5 PSF
 DL = 7.0 PSF
 TOTAL LOAD = 62.5 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2016

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012
 - CSA 086-09, CSA 086-14
 - TPC 2011, TPC 2014

(65 % OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.90")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.99")
 ALLOWABLE DEFL.(TL) = L/360 (0.90")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.99")

CS1: TC=0.32/1.00 (D-E-1), BC=0.34/1.00 (G-L-1), WB=0.74/1.00 (E-N-1), BS=0.23/1.00 (D-E-1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1867 768 1867 1868

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (H) (INPUT = 0.80)
 JSI METAL = 0.51 (M) (INPUT = 1.00)

DRWG NO. TAM 71910764
 STRUCTURAL
 CALCULATIONS ONLY

EWING MFG. CO. TAM 7910765
STRUCTURAL
CONCRETE ONLY

JOB NAME 402938	TRUSS NAME 17	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.230 8 Nov 17 2018 Mitek Industries, Inc. Tue May 7 17:41:44 2018 Page 1	
				ID: VdmZNIanRCr_YT1p7OGrtzKFlu-JgVkdqWR888jnwTeh2NXJ8aUQkVxltqy7D1Bafzlgjb 15-8-11 5-7-7 21-2-1 5-9-15 27-0-0 1-3-8 Scale = 1:87.4	

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
J - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
E - M	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	6.0	1.75	3.25
C	TMWW-t	MT20	4.0	4.0	2.00	1.50
D	TS-t	MT20	3.0	6.0		
E	TTWW+m	MT20	5.0	6.0	2.25	1.50
F	TTW-m	MT20	4.0	4.0		
G	TS-t	MT20	3.0	6.0		
H	TMWV-t	MT20	4.0	4.0	2.00	1.50
I	TMWV-p	MT20	5.0	6.0	1.75	3.25
K	BMV1-p	MT20	3.0	4.0		
L	BMWV-t	MT20	5.0	6.0		
M	BMWWV-t	MT20	4.0	9.0		
N	BS-t	MT20	3.0	6.0		
O	BMWW-t	MT20	4.0	4.0		
P	BMWW-t	MT20	5.0	6.0		
Q	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	JT	GROSS REACTION	BRG	BRG	BRG	BRG
Q	2039	0	2039	0	0	5-8	5-8
K	2039	0	2039	0	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS
Q	1515	884 / 0	284 / 0	PERM. LIVE	WIND
K	1515	884 / 0	284 / 0	0 / 0	DEAD
				0 / 0	SOIL

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 42	-102.1 -102.1	0.14 (1)	P-C	-83 / 176	0.04 (1)	
B-C	-2028 / 0	-102.1 -102.1	0.54 (1)	C-O	-524 / 0	0.70 (1)	
C-D	-1845 / 0	-102.1 -102.1	0.49 (1)	O-E	0 / 835	0.12 (1)	
D-E	-1845 / 0	-102.1 -102.1	0.49 (1)	E-M	0 / 3	0.00 (1)	
E-F	-1285 / 0	-102.1 -102.1	0.24 (1)	M-F	0 / 340	0.12 (1)	
F-G	-1847 / 0	-102.1 -102.1	0.49 (1)	M-H	-322 / 0	0.89 (1)	
G-H	-1847 / 0	-102.1 -102.1	0.49 (1)	H-I	-88 / 173	0.05 (1)	
H-I	-2027 / 0	-102.1 -102.1	0.54 (1)	B-P	0 / 1680	0.38 (1)	
I-J	0 / 42	-102.1 -102.1	0.14 (1)	L-I	0 / 1680	0.38 (1)	
Q-B	-1849 / 0	0.0	0.0				
K-I	-1849 / 0	0.0	0.0				
Q-P	0 / 0	-38.5 -38.5	0.25 (3)				
P-O	0 / 1655	-38.5 -38.5	0.46 (2)				
O-N	0 / 1285	-38.5 -38.5	0.31 (1)				
N-M	0 / 1285	-38.5 -38.5	0.31 (1)				
M-L	0 / 1655	-38.5 -38.5	0.46 (2)				
L-K	0 / 0	-38.5 -38.5	0.25 (3)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.1 PSF
DL = 8.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 8, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 8 OF BCBC 2010, CBC 2012
- CSA 098-09, CSA 098-14
- TPIC 2011, TPIC 2014

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.90")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (0.90")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.12")

CSI TC=0.54/1.00 (B-C-1), BC=0.46/1.00 (O-P-2), WS=0.70/1.00 (C-O-1), SS=0.22/1.00 (B-C-1)

DOJ LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (FL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1657 798 1657 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.89 (B) (INPUT = 0.80)
JSI METAL= 0.41 (P) (INPUT = 1.00)

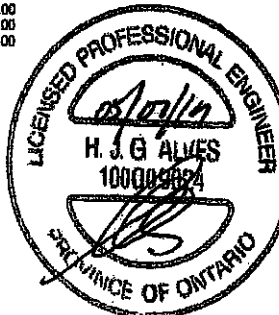

DRWG NO. TAM T1910766
STRUCTURAL
CONSTRUCTION ONLY

JOB NAME 402981	TRUSS NAME T9S	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.230 S Nov 17 2018 MTek Industries, Inc. Wed May 8 15:15:39 2019 Page 1 ID:JIMS6RLJVLhc2enmluv9GyJDZVW-5N0zAxS92VIDEL_T8HIDJoVpSTILpu59GBgo9JzlXmY	

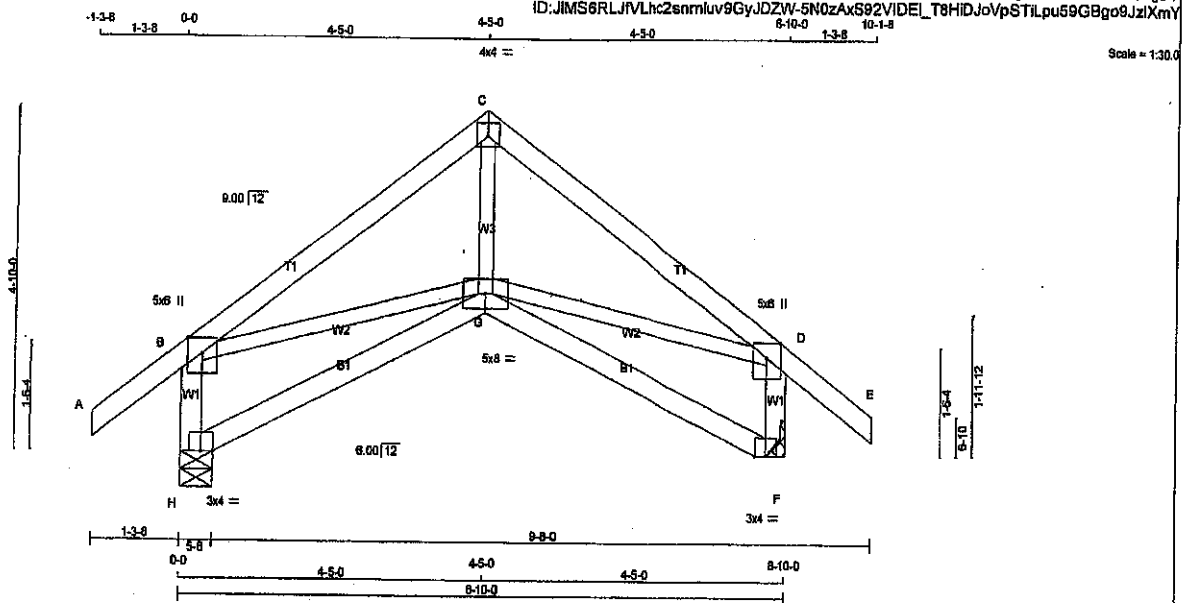

TOTAL WEIGHT = 3 X 39 = 118 lb
(M/F)

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
H - B	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge	
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TMVW-p	MT20	5.0	6.0	Edge	
F	BVM1-p	MT20	3.0	4.0		
G	BBWW-p	MT20	5.0	6.0		
H	BVM1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
H	762	762	0	5-8
F	762	762	0	5-8 MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3-8.

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	561	337 / 0	93 / 0	0 / 0	0 / 0	0 / 0	131 / 0	0 / 0
F	561	337 / 0	93 / 0	0 / 0	0 / 0	0 / 0	131 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)
FR-TO				FR-TO			
A-B	0 / 42	-102.1	-102.1	0.14 (1)	10.00	G-C	0 / 369
B-C	-683 / 0	-102.1	-102.1	0.26 (1)	8.25	B-G	0 / 566
C-D	-683 / 0	-102.1	-102.1	0.26 (1)	8.25	G-D	0 / 566
D-E	0 / 42	-102.1	-102.1	0.14 (1)	10.00		
H-B	-677 / 0	0.0	0.0	0.07 (1)	7.81		
F-D	-677 / 0	0.0	0.0	0.07 (1)	7.81		
H-G	0 / 0	-38.5	-38.5	0.18 (3)	10.00		
G-F	0 / 0	-38.5	-38.5	0.18 (3)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.26")
CALCULATED VERT. DEFL. (LL) = L/999 (0.03")
ALLOWABLE DEFL. (TL) = L/360 (0.26")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSI: TC=0.26/1.00 (C-D:1), BC=0.18/1.00 (F-G:3),
WB=0.13/1.00 (B-G:1), SE=0.14/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 768 1667 1655

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.70 (C) (INPUT = 0.80)
JSI METAL = 0.40 (H) (INPUT = 1.00)

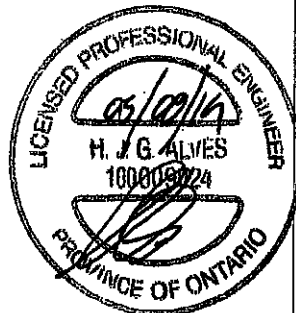

DRWG NO. TAM 1791 0988
STRUCTURAL
CROSS SECTION ONLY

JOB NAME 402938	TRUSS NAME T10	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.230 8 Nov 17 2018 Mitek Industries, Inc. Tue May 7 17:41:46 2019 Page 1	

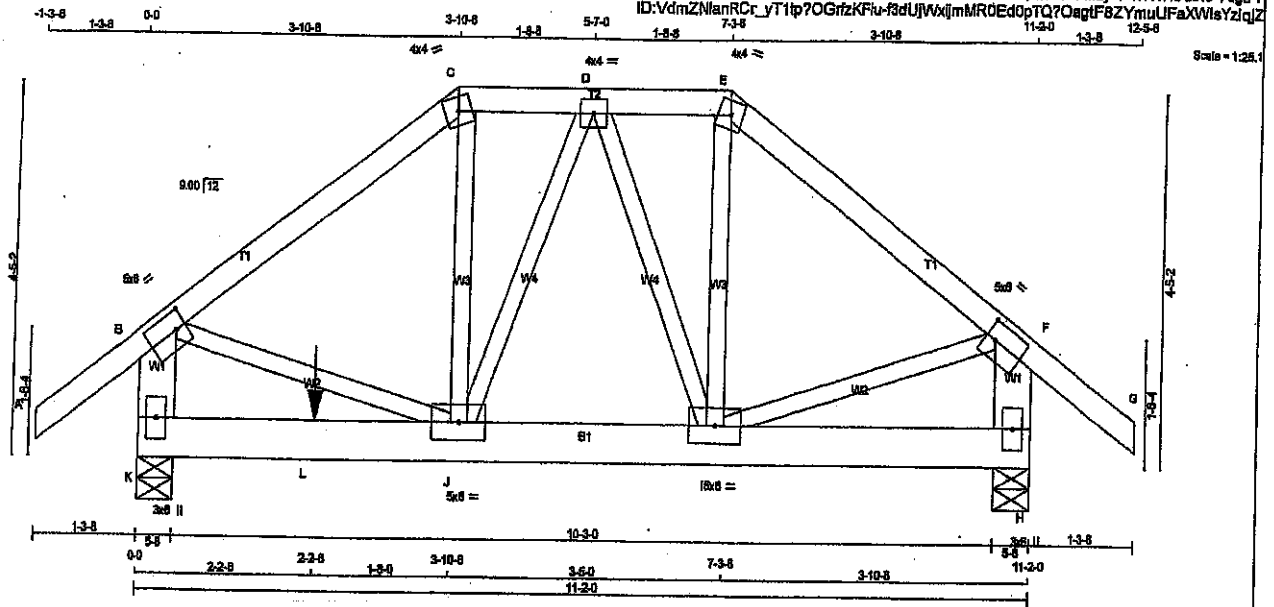

TOTAL WEIGHT = 61 lb

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
K - B	2x6	DRY	No.2	SPF
H - F	2x6	DRY	No.2	SPF
K - H	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQ'D BRG
JT	VERT	DOWN	UPLIFT	IN-SX
K	1894 0	1894 0	0	5-8
H	1115 0	1115 0	0	5-8

UNFACTORED REACTIONS	1ST LCASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERMLIVE WIND DEAD SOIL
K	1240	788 / 0 188 / 0 0 / 0 0 / 0 285 / 0 0 / 0
H	821	494 / 0 135 / 0 0 / 0 0 / 0 192 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO						FR-TO			
A-B	0 / 42	-102.1	-102.1	0.15 (1)	10.00	J-C	0 / 413	0.10 (1)	
B-C	-1160 / 0	-102.1	-102.1	0.32 (1)	5.47	I-E	0 / 227	0.08 (2)	
C-D	-938 / 0	-102.1	-102.1	0.06 (1)	6.25	B-J	0 / 981	0.24 (1)	
D-E	-672 / 0	-102.1	-102.1	0.05 (1)	6.25	I-F	0 / 891	0.17 (1)	
E-F	-834 / 0	-102.1	-102.1	0.31 (1)	8.21	J-D	0 / 284	0.07 (1)	
F-G	0 / 42	-102.1	-102.1	0.15 (1)	10.00	D-I	-455 / 0	0.15 (1)	
K-B	-1285 / 0	0.0	0.0	0.09 (1)	7.81				
H-F	-1027 / 0	0.0	0.0	0.07 (1)	7.81				
K-L	0 / 0	-38.5	-38.5	0.58 (1)	10.00				
L-J	0 / 0	-38.5	-38.5	0.58 (1)	10.00				
J-I	0 / 839	-38.5	-38.5	0.41 (1)	10.00				
I-H	0 / 0	-38.5	-38.5	0.08 (2)	10.00				

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
	L	2-3-8	-898	-898	-	FRONT	VERT	TOTAL	-	-

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.1 PSF
DL = 8.0 PSF
BOT CH. LL = 10.6 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012
- CSA 089-09, CSA 089-14
- TPIC 2011, TPIC 2014

(55 % OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/800 (0.37")
CALCULATED VERT. DEFL. (LL) = L/989 (0.04")
ALLOWABLE DEFL. (TL) = L/800 (0.37")
CALCULATED VERT. DEFL. (TL) = L/999 (0.06")

CSI: TC=0.32/1.00 (B-C-1), BC=0.58/1.00 (J-K-1), WB=0.24/1.00 (B-J-1), SS=0.47/1.00 (J-K-1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1887 788	1887 1888

PLATE PLACEMENT TOL = 0.250 Inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.88 (F) (INPUT = 0.80)
JSI METAL= 0.34 (F) (INPUT = 1.00)

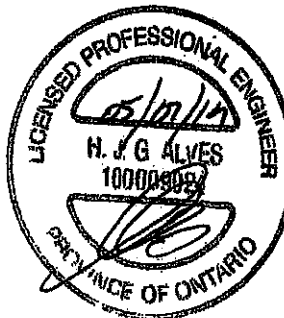

DRWG NO. TAM 71710768
STRUCTURAL
C/C 24.00 IN ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
402938	T11	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

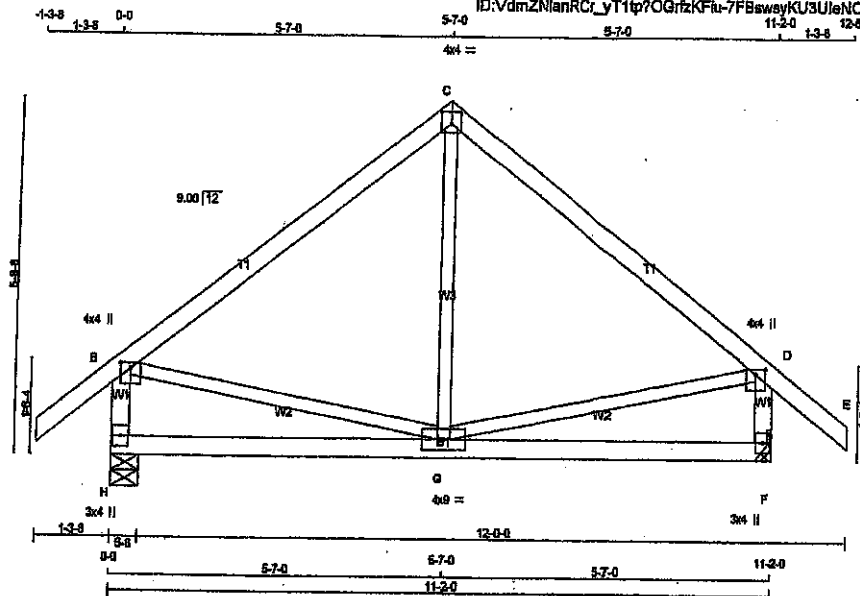

Scale = 1/32

LUMBER	N.L. & A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF		
C - E	2x4 DRY	No.2	SPF		
H - B	2x4 DRY	No.2	SPF		
F - D	2x4 DRY	No.2	SPF		
H - F	2x4 DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TM/VW+p	MT20	4.0	4.0	1.00	2.00	
C	TTW+p	MT20	4.0	4.0	2.25	2.00	
D	TM/VW+p	MT20	4.0	4.0	1.00	2.00	
F	BM/V1+p	MT20	3.0	4.0			
G	BM/VWV+t	MT20	4.0	9.0			
H	BM/V1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
H	928	0	0	0
F	928	0	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3'-8".

UNFACTORED REACTIONS

1ST CASE	MAX./MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	683	404 / 0	117 / 0	0 / 0	0 / 0	162 / 0	0 / 0
F	683	404 / 0	117 / 0	0 / 0	0 / 0	162 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX	UNBRAC	MEMB.	MAX. FACTORED	MAX	CS1 (LC)
MEMB.	FORCE (LBS)	VERT. (PLF)	CS1 (LC)	UNBRAC	LENGTH	FR-TO	TO	FR-TO	FORCE (LBS)	MAX	CS1 (LC)
A-B	0 / 42	-102.1	-102.1	0.14 (1)	10.00	G-C	0 / 248	0.06 (3)			
B-C	-543 / 0	-102.1	-102.1	0.41 (1)	6.25	B-G	0 / 444	0.10 (1)			
C-D	-543 / 0	-102.1	-102.1	0.41 (1)	6.25	G-D	0 / 444	0.10 (1)			
D-E	0 / 42	-102.1	-102.1	0.14 (1)	10.00						
H-B	-844 / 0	0.0	0.0	0.08 (1)	7.81						
F-D	-844 / 0	0.0	0.0	0.08 (1)	7.81						
H-G	0 / 0	-38.5	-38.5	0.27 (3)	10.00						
G-F	0 / 0	-38.5	-38.5	0.27 (3)	10.00						

TOTAL WEIGHT = 3 X 48 = 144 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 29.1 PSF
DL	= 8.0 PSF
BOY CH. LL	= 10.5 PSF
DL	= 7.0 PSF
TOTAL LOAD	= 32.5 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2015, CBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.37")
CALCULATED VERT. DEFL. (LL) = L/999 (0.03")
ALLOWABLE DEFL. (TL) = L/360 (0.37")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CS1: TC=0.41/1.00 (B-C:1), SC=0.27/1.00 (F-G:3),
WB=0.10/1.00 (D-G:1), SS=0.18/1.00 (B-C:1)

DOI LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (FL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1888

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.81 (D) (INPUT = 0.80)
JSI METAL= 0.21 (B) (INPUT = 1.00)

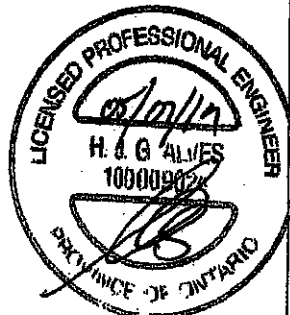


ENGINEER TAM 77910769
STRUCTURAL
CALCULATIONS ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
402979	T12	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MITek Industries, Inc. Wed May 8 15:08:09 2019 Page 1
ID:JpMxDeRQ69GD6IO953aPwyJEIZ-13nRr_vE8TTLDPFIQzaC7_RIS32mJbJH_?XQzIXIj

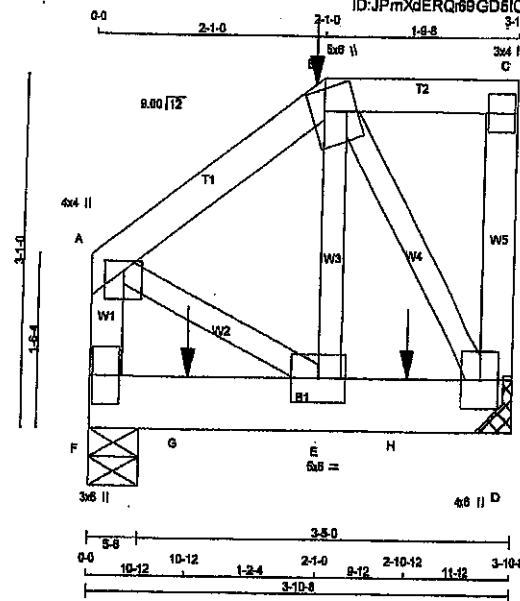

Scale = 1:18.8

LUMBER				N. L. G. A. RULES	
CHORDS	SIZE	LUMBER	DESCR.	SPF	
F - A	2x4	DRY	No.2	SPF	
A - B	2x4	DRY	No.2	SPF	
B - C	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	
F - D	2x6	DRY	No.2	SPF	
ALL WEBS				2x3	DRY
DRY: SEASONED LUMBER.				No.2	SPF

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122'x3') SPIRAL NAILS		
F-A 1	12	TOP
A-B 1	12	SIDE(61.0)
B-C 1	12	SIDE(61.0)
C-D 1	12	TOP
BOTTOM CHORDS : (0.122'x3') SPIRAL NAILS		
F-D 2	12	SIDE(61.0)
WEBS : (0.122'x3') SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
B	TTWV+m	MT20	5.0	8.0	2.25	1.50
C	TMVW+p	MT20	3.0	4.0		
D	BMVW+p	MT20	4.0	8.0		
E	BMVW+m	MT20	5.0	8.0		
F	BMVW+p	MT20	3.0	8.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
F	903	0	903	0	5-8
D	883	0	883	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	887	394 / 0	115 / 0	0 / 0	0 / 0	158 / 0	0 / 0
D	861	388 / 0	111 / 0	0 / 0	0 / 0	154 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8-25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED	FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT.	LOAD LC1	MAX. CS1 (LC)	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	LENGTH	FR-TO	
F-A	-583 / 0	0.0	0.0	0.03 (1)	A-E	0 / 405
A-B	-453 / 0	-102.1	-102.1	0.04 (1)	E-B	0 / 379
B-C	0 / 0	-102.1	-102.1	0.03 (1)	B-D	-892 / 0
D-C	-81 / 0	0.0	0.0	0.01 (1)		
F-G	0 / 0	-38.5	-38.5	0.11 (1)		
G-E	0 / 0	-38.5	-38.5	0.11 (1)		
E-H	0 / 383	-38.5	-38.5	0.10 (1)		
H-D	0 / 383	-38.5	-38.5	0.10 (1)		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
B	2-1-0	-73	-73		BACK	VERT	TOTAL		
G	10-12	-585	-585		FRONT	VERT	TOTAL		
H	2-10-12	-583	-583		FRONT	VERT	TOTAL		

TOTAL WEIGHT = 2 X 22 = 43 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.1 PSF
DL = 8.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, CBC 2012
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(85 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19')
CALCULATED VERT. DEFL.(LL) = L/999 (0.00')
ALLOWABLE DEFL.(TL) = L/360 (0.19')
CALCULATED VERT. DEFL.(TL) = L/999 (0.00')

CS1: TC=0.04/1.00 (A-B:1), BC=0.11/1.00 (E-F:1),
WB=0.07/1.00 (B-E:1), SG=0.14/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 798 1987 1689

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

GRIP=0.28 (A) (INPUT = 0.80)
METAL=0.09 (D) (INPUT = 1.00)

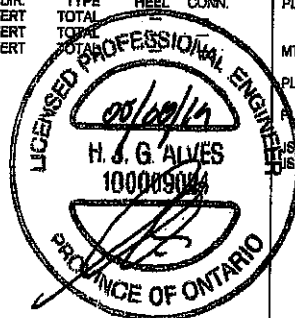

DRWG NO. TAM 179/0979
STRUCTURAL
CHECKED ONLY

JOB NAME 402938	TRUSS NAME T13	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Farmersack Roof Truss, Burlington		Version 8.230 6 Nov 17 2018 Mitek Industries, Inc. Tue May 7 17:41:48 2019 Page 1		ID:VdmZNlanRCr_yT1p?OGfzKFlu-bRIE7CzyFNc9GXmPwuSTU7IGCxK0ErjY2r7PxQzqjX	
		TRUSS DESC.			

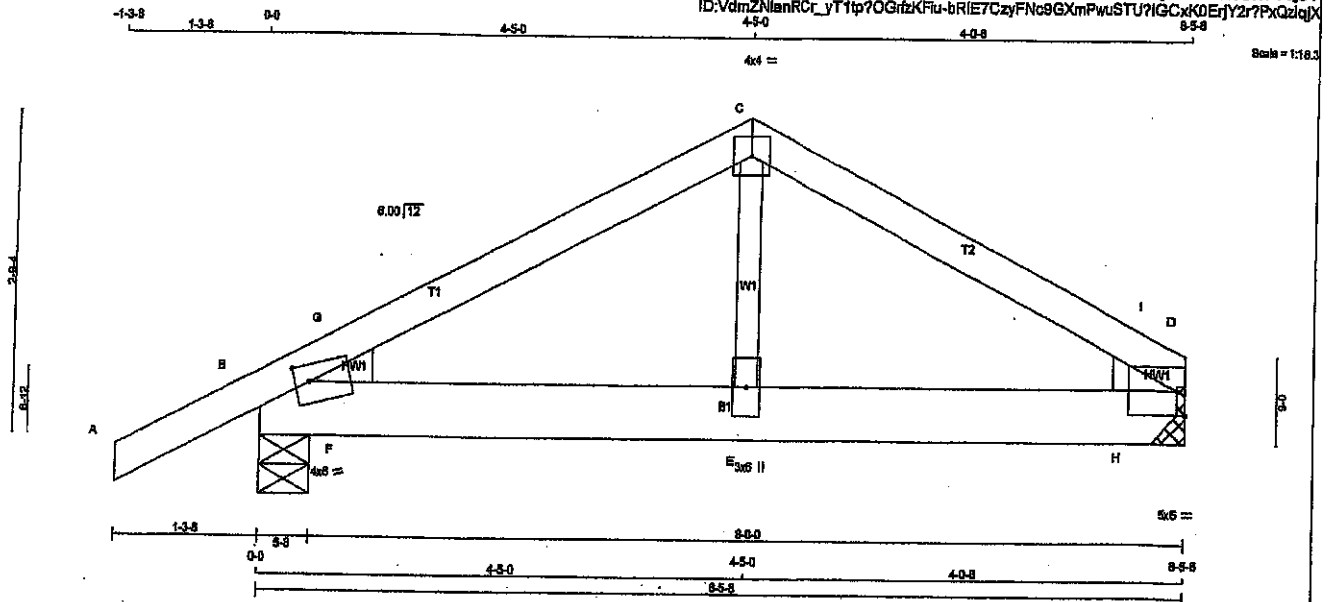

TOTAL WEIGHT = 31 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
B - D	2x6	DRY	No.2	SPF	
ALL WEBS	2x6	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMBH1-m	MT20	4.0	8.0	1.75	1.50
C	TTW-p	MT20	4.0	4.0		
D	TMBH1-j	MT20	5.0	6.0		Edge
E	BMW-w	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD	HEEL
	GROSS REACTION	GROSS REACTION	BRG	BRG	WEDGE
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
B	733	0	733	0	0
D	885	0	885	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 3-8.

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
B	540	324 / 0	88 / 0	0 / 0	0 / 0	128 / 0
D	444	246 / 0	88 / 0	0 / 0	0 / 0	110 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	CS1 (LC)	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
A-B	0 / 24	-102.1	-102.1	0.13 (1)	10.00
B-G	-835 / 0	-102.1	-102.1	0.10 (1)	8.25
G-C	-850 / 0	-102.1	-102.1	0.17 (1)	8.25
C-I	-855 / 0	-102.1	-102.1	0.14 (1)	8.25
I-D	-713 / 0	-102.1	-102.1	0.13 (1)	8.25
B-F	0 / 572	-38.5	-38.5	0.19 (1)	10.00
F-E	0 / 572	-38.5	-38.5	0.19 (1)	10.00
E-H	0 / 572	-38.5	-38.5	0.14 (1)	10.00
H-D	0 / 572	-38.5	-38.5	0.10 (1)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:	TOP CH.	LL	DL	PSF
			28.1	PSF
		DL	6.0	PSF
	BOT CH.	LL	10.6	PSF
		DL	7.0	PSF
	TOTAL LOAD		82.5	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2015, OBC 2012
- CSA 086-09, CSA 086-14
- TFC 2011, TFC 2014

(85 % OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.28")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CS1: TC=0.17/1.00 (C-G-1), SC=0.18/1.00 (E-F-1), WS=0.08/1.00 (C-E-2), SS=0.16/1.00 (B-F-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 364 1687 798 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.70 (D) (INPUT = 0.90)
JSI METAL= 0.18 (B) (INPUT = 1.00)

THIS STRUCTURE MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE PROVISIONS OF
THE ONTARIO BUILDING CODE

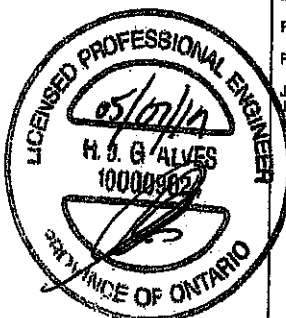


DRG NO. TAM 19/0771
STRUCTURAL
COMMENT ONLY

JOB NAME 402981	TRUSS NAME G14	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Wed May 8 15:15:34 2018 Page 1
ID: JIMS6RLJVLhc2snmluv9GyJDZW-kPC47D00Dzbx7_8VLk62cin_IS088eFQ8wz1T6ziXmd

Scale = 1/20.5

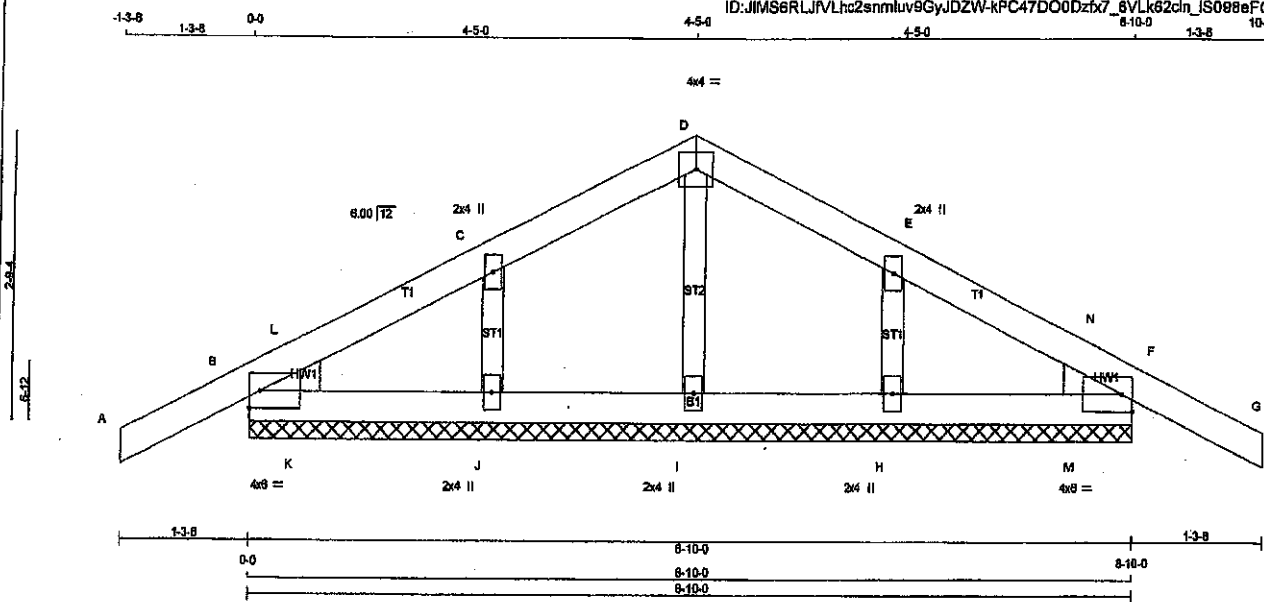

TOTAL WEIGHT = 30 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
B - F	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
ALL GABLE WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMBH-I	MT20	4.0	6.0		Edge
C	TMBW-w	MT20	2.0	4.0		
D	TTW-p	MT20	4.0	4.0		
E	TMBW-w	MT20	2.0	4.0		
F	TMBH-I	MT20	4.0	6.0		Edge
H, I, J						
H	BMW1-w	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
HEEL
WEDGE
2x4 L
2x4 R
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/21	-102.1 -102.1	0.13 (1)	I-D	-94/8	0.02 (1)	
B-L	-121/0	-102.1 -102.1	0.02 (3)	J-C	-254/0	0.04 (1)	
L-C	-71/0	-102.1 -102.1	0.07 (1)	H-E	-254/0	0.04 (1)	
C-D	-85/0	-102.1 -102.1	0.07 (1)	K-L	-29/31	0.00 (1)	
D-E	-85/0	-102.1 -102.1	0.07 (1)	M-N	-29/31	0.00 (1)	
E-N	-71/0	-102.1 -102.1	0.07 (1)				
N-F	-121/0	-102.1 -102.1	0.02 (3)				
F-G	0/21	-102.1 -102.1	0.13 (1)				
B-K	0/77	-38.5 -38.5	0.05 (1)				
K-J	0/77	-38.5 -38.5	0.05 (2)				
J-I	0/85	-38.5 -38.5	0.05 (2)				
I-H	0/85	-38.5 -38.5	0.05 (2)				
H-M	0/77	-38.5 -38.5	0.05 (2)				
M-F	0/77	-38.5 -38.5	0.05 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012
- CSA 086-06, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (A-B-1), BC=0.05/1.00 (J-K-2),
WB=0.04/1.00 (E-H-1), SS=0.10/1.00 (F-G-1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.31 (F) (INPUT = 0.90)
JSI METAL= 0.11 (C) (INPUT = 1.00)

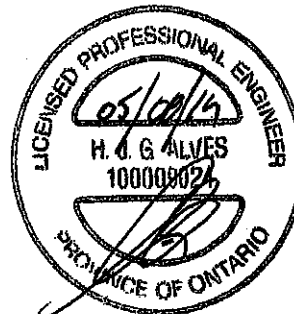

DRWG NO. TAM 09/10982
STRUCTURAL
EXHIBIT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
402981	T20	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Wed May 8 15:15:40 2019 Page 1
 ID: JIMS8RLJW/Lhc2anmluy9GyJDZW-ZZaLOHTnopQ4rvZf?DS01xrtYhYH3UuQLhizXmX
 Scale = 1:30.0

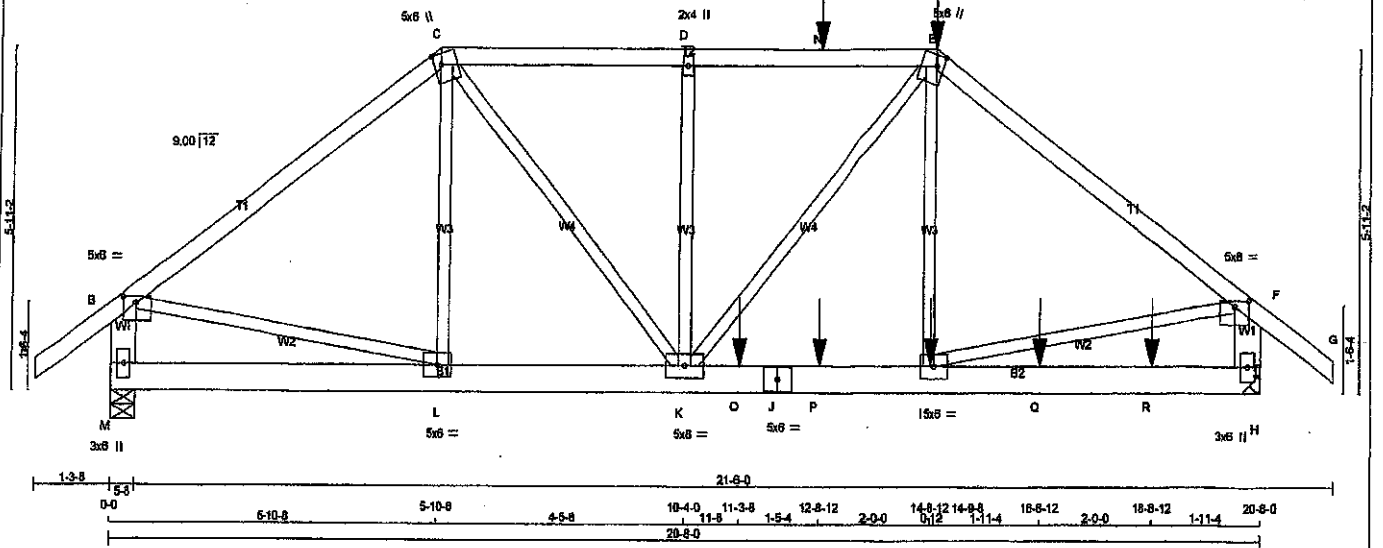

TOTAL WEIGHT = 2 X 104 = 208 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
M - B	2x6	DRY	No.2
H - F	2x6	DRY	No.2
M - J	2x6	DRY	No.2
J - H	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
C - E	12	SIDE(81.0)
E - G	12	SIDE(81.0)
M - B	12	TOP
H - F	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
M - J	12	SIDE(0.0)
J - H	12	SIDE(183.1)
WEBS: (0.122"x3") SPIRAL NAILS		
I - E	6	SIDE(14.7)
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.25 3.00
C	TTVW+m	MT20	5.0	6.0	2.25 1.50
D	TMVW-w	MT20	2.0	4.0	
E	TTVW+m	MT20	5.0	6.0	2.25 1.50
F	TMVW-p	MT20	5.0	6.0	1.25 3.00
H	BMV1+p	MT20	3.0	6.0	
I	BMVW-t	MT20	5.0	6.0	
J	BS-t	MT20	5.0	6.0	
K	BMVW-t	MT20	5.0	6.0	
L	BMVW-t	MT20	5.0	6.0	
M	BMV1+p	MT20	3.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
FACTORED	MAXIMUM FACTORED	INPUT	REQD		
GROSS REACTION	GROSS REACTION	BRG	BRG		
JT VERT	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
M 2545	0	2545	0	5-8	5-8
H 3080	0	3080	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 4-0.

UNFACTORED REACTIONS

1ST CASE	MAX/MIN COMPONENT REACTIONS						
JT COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
M	1874	1117 / 0	308 / 0	0 / 0	450 / 0	0 / 0	
H	2268	1327 / 0	380 / 0	0 / 0	559 / 0	0 / 0	

BEARING MATERIAL TO BE SFF NO.2 OR BETTER AT JOINT(S) M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.64 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 42	-102.1	-102.1 0.08 (1)	10.00	L-C	-275 / 86	0.07 (1)
B-C	-2659 / 0	-102.1	-102.1 0.43 (1)	5.11	C-K	0 / 1790	0.22 (1)
C-D	-3242 / 0	-102.1	-102.1 0.25 (1)	4.90	K-D	-808 / 0	0.18 (1)
D-N	-3242 / 0	-102.1	-102.1 0.25 (1)	4.90	K-E	0 / 914	0.11 (1)
N-E	-3242 / 0	-102.1	-102.1 0.25 (1)	4.90	I-E	0 / 407	0.08 (3)
E-F	-3335 / 0	-102.1	-102.1 0.48 (1)	4.84	B-L	0 / 2480	0.27 (1)
F-G	0 / 42	-102.1	-102.1 0.08 (1)	10.00	I-F	0 / 2480	0.27 (1)
M-B	-2435 / 0	0.0	0.0 0.08 (1)	7.81			
H-F	-2841 / 0	0.0	0.0 0.11 (1)	7.81			
M-L	0 / 0	-38.5	-38.5 0.07 (2)	10.00			
L-K	0 / 2119	-38.5	-38.5 0.28 (1)	10.00			
K-O	0 / 2688	-38.5	-38.5 0.49 (1)	10.00			
O-J	0 / 2688	-38.5	-38.5 0.49 (1)	10.00			
J-P	0 / 2688	-38.5	-38.5 0.49 (1)	10.00			
P-I	0 / 2688	-38.5	-38.5 0.49 (1)	10.00			
I-Q	0 / 0	-38.5	-38.5 0.15 (2)	10.00			
Q-R	0 / 0	-38.5	-38.5 0.15 (2)	10.00			
R-H	0 / 0	-38.5	-38.5 0.15 (2)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TOTAL
E	14-8-12	-524	-524		FRONT	VERT	TOTAL
I	14-8-12	-28	-28		FRONT	VERT	TOTAL
N	12-8-12	-123	-123		FRONT	VERT	TOTAL
O	11-3-8	-1578	-1578		FRONT	VERT	TOTAL
P	12-8-12	-28	-28		FRONT	VERT	TOTAL
Q	16-8-12	-75	-75		FRONT	VERT	TOTAL
R	18-8-12	-75	-75		FRONT	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 28.1 PSF
 DL = 6.0 PSF
 BOT CH. LL = 10.5 PSF
 DL = 7.0 PSF
 TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, CBC 2012
 - CSA 086-08, CSA 086-14
 - TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.69")
 CALCULATED VERT. DEFL.(LL) = L/989 (0.08")
 ALLOWABLE DEFL.(TL) = L/360 (0.69")
 CALCULATED VERT. DEFL.(TL) = L/989 (0.08")

CS1: TC=0.48/1.00 (E-F-1), BC=0.48/1.00 (I-K-1),
 WB=0.34/1.00 (F-1), SS=0.44/1.00 (I-K-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 M20 818 354 1687 788 1987 1655

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.78 (E) (INPUT = 0.90)
 JSI METAL= 0.54 (J) (INPUT = 1.00)

DRWG NO. TAM 7910989
 SCALE: 1:30.0
 DATE: 2019-05-08


JOB NAME 402981	TRUSS NAME T21	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 M Tek Industries, Inc. Wed May 8 15:15:41 2019 Page 1

ID: JIMS6RLJ/VLhc2anmluv9GyJDZW-177jbdUPZ7YxT38rGkhd0a8XHNbHJXRJV9vDCziXmVv

Scale: 1/2"=1'

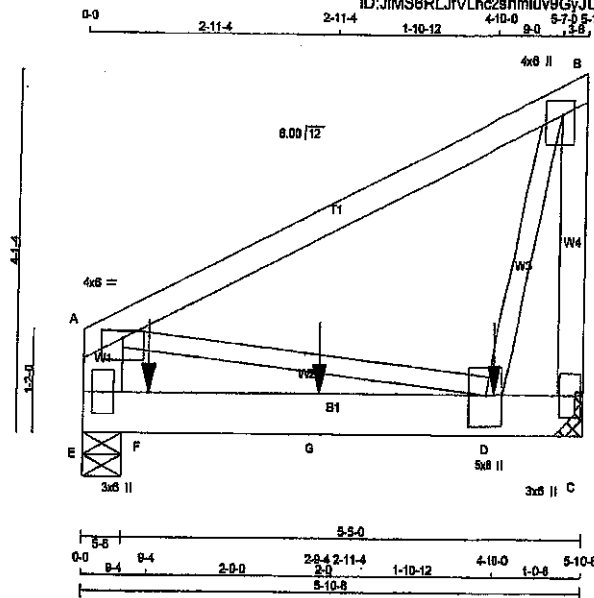

TOTAL WEIGHT = 2 X 29 = 58 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - A	2x6 DRY	No.2	SPF		
A - B	2x4 DRY	No.2	SPF		
C - B	2x4 DRY	No.2	SPF		
E - C	2x6 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
DRY: SEASONED LUMBER.					

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
E-A 2	12	TOP
A-B 1	12	TOP
B-C 1	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
E-C 2	12	SIDE (0.0)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-p	MT20	4.0	8.0	1.00 3.00
B	TMVW-p	MT20	4.0	8.0	2.00 1.75
C	BMV1-p	MT20	3.0	6.0	
D	BMVW-p	MT20	5.0	8.0	4.25 2.50
E	BMV1-p	MT20	3.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
E	1309	0	1309	0
C	3038	0	3038	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT C. MINIMUM BEARING LENGTH AT JOINT C = 4'-0.

UNFACTORED REACTIONS

JT	1ST CASE	MAX / MIN	COMPONENT REACTIONS
	COMBINED	SNOW	LIVE
E	952	605 / 0	130 / 0
C	2233	1335 / 0	358 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1	MAX. CS1 (LC)	MAX. UNBRACED LENGTH
FR-TO		FROM TO		FR-TO
E-A	-858 / 0	0.0 0.0 0.03 (1)	7.81	A-D 0 / 852 0.11 (1)
A-B	-841 / 0	-102.1 -102.1 0.35 (1)	6.25	D-B 0 / 3115 0.39 (1)
C-B	-2878 / 0	0.0 0.0 0.35 (1)	6.77	
E-F	0 / 0	-38.5 -38.5 0.19 (1)	10.00	
F-G	0 / 0	-38.5 -38.5 0.19 (1)	10.00	
G-D	0 / 0	-38.5 -38.5 0.19 (1)	10.00	
D-C	0 / 0	-38.5 -38.5 0.05 (1)	10.00	

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC	LC1	MAX	FACE	DIR.	TYPE	HEEL	CONN.
D	4-10-0	-3031	-3031	---	BACK	VERT	TOTAL	---
F	8-4	-288	-288	---	BACK	VERT	TOTAL	---
G	2-9-4	-192	-192	---	BACK	VERT	TOTAL	---

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA D88-08, CSA D88-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.04")

CSI: TC=0.35/1.00 (B-C:1), BC=0.19/1.00 (D-E:1), WB=0.39/1.00 (B-D:1), SS=0.15/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1867 788 1867 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.84 (B) (INPUT = 0.90)
JSI METAL= 0.28 (D) (INPUT = 1.00)

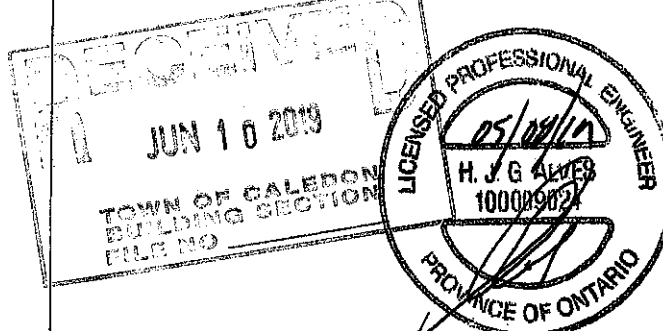

DWG NO. TAM 1910990
STRUCTURAL
6/10/2019

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
402938	PB1	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.230 S Nov 17 2018 MITak Industries, Inc. Tue May 7 17:41:35 2019 Page 1
ID:VdmZNlenRCr_yT1tp?QGrtzKFlu-UxSKPipJNz?CXHvHjQSFJ3llyDhyCd2JLD_gzlgjk

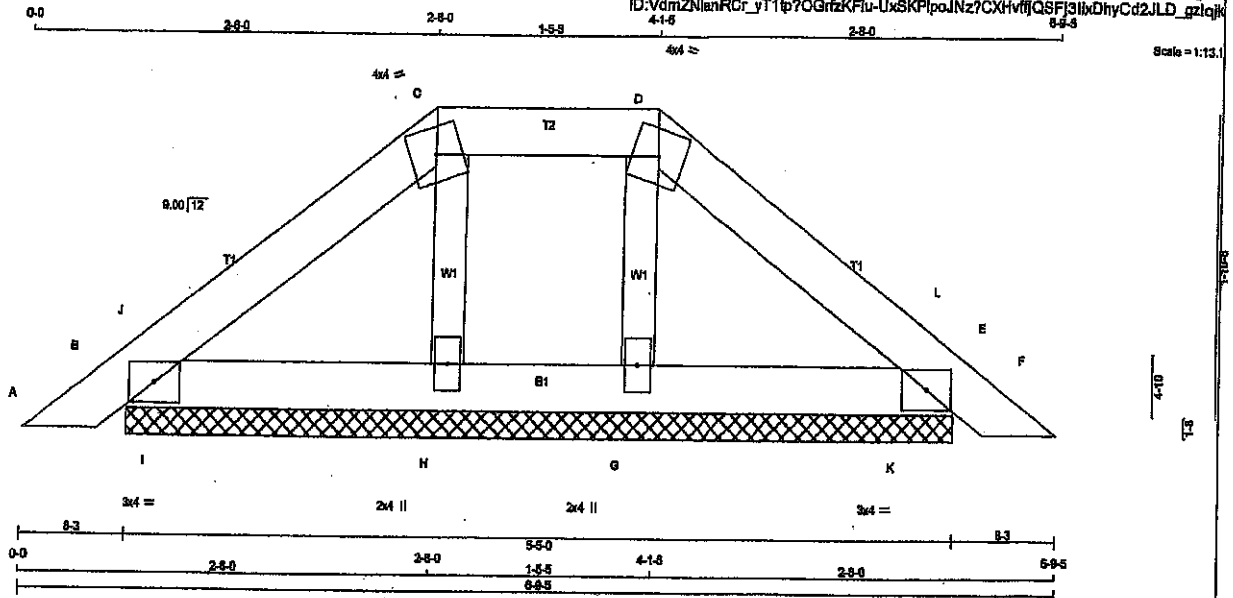

Scale = 1:12.1

TOTAL WEIGHT = 2 X 18 = 35 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
B - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	JT	GROSS REACTION	BRG	BRG	BRG	BRG
B	233	0	233	0	0	5-5-0	5-5-0
E	233	0	233	0	0	5-5-0	5-5-0
H	208	0	208	0	0	5-5-0	5-5-0
G	208	0	208	0	0	5-5-0	5-5-0

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.1 PSF
DL = 8.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN/CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.5 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

CSL TO=0.05/1.00 (D-L-1), BC=0.05/1.00 (G-K-1), WB=0.02/1.00 (D-G-1), SS=0.05/1.00 (E-K-1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1887 768 1987 1986

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)
JSI METAL = 0.04 (B) (INPUT = 1.00)

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TM81-I	MT20	3.0	4.0	
C	TTW-m	MT20	4.0	4.0	
D	TTW-m	MT20	4.0	4.0	
E	TM81-I	MT20	3.0	4.0	
G	BMW1+w	MT20	2.0	4.0	
H	BMW1+w	MT20	2.0	4.0	

UNFACTORED REACTIONS

1ST LOASE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
B	188	111/0	21/0	0/0	0/0	37/0	0/0
E	188	111/0	21/0	0/0	0/0	37/0	0/0
H	158	81/0	38/0	0/0	0/0	41/0	0/0
G	188	81/0	38/0	0/0	0/0	41/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING


TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING


TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO			
A-B	0/17	-102.1	-102.1 0.03 (1)	10.00	H-C	-121/0	0.02 (1)
B-J	-84/0	-102.1	-102.1 0.01 (8)	6.25	G-D	-121/0	0.02 (1)
J-C	-85/0	-102.1	-102.1 0.05 (1)	6.25	I-J	-103/22	0.00 (1)
C-D	-43/0	-102.1	-102.1 0.04 (1)	6.25	K-L	-103/22	0.00 (1)
D-L	-85/0	-102.1	-102.1 0.05 (1)	6.25			
L-E	-84/0	-102.1	-102.1 0.01 (3)	6.25			
E-F	0/17	-102.1	-102.1 0.03 (1)	10.00			
B-I	0/51	-38.5	-38.5 0.05 (1)	10.00			
I-H	0/51	-38.5	-38.5 0.05 (1)	10.00			
H-G	0/43	-38.5	-38.5 0.04 (1)	10.00			
G-K	0/51	-38.5	-38.5 0.05 (1)	10.00			
K-E	0/51	-38.5	-38.5 0.05 (1)	10.00			

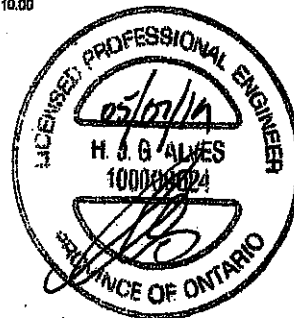

DRWG NO. TAM 71910757
STRUCTURAL
COMPONENT ONLY

JOB NAME 402938	TRUSS NAME PB2	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.230 5 Nov 17 2016 MTEK Industries, Inc. Tue May 7 17:41:36 2016 Page 1 ID:VdmZNianRCr_yT1p7OGfzKFlu-y70lcSpQ4h6aqhe5DMEF_TFCR6FeQPjnHz5mV7z1q			

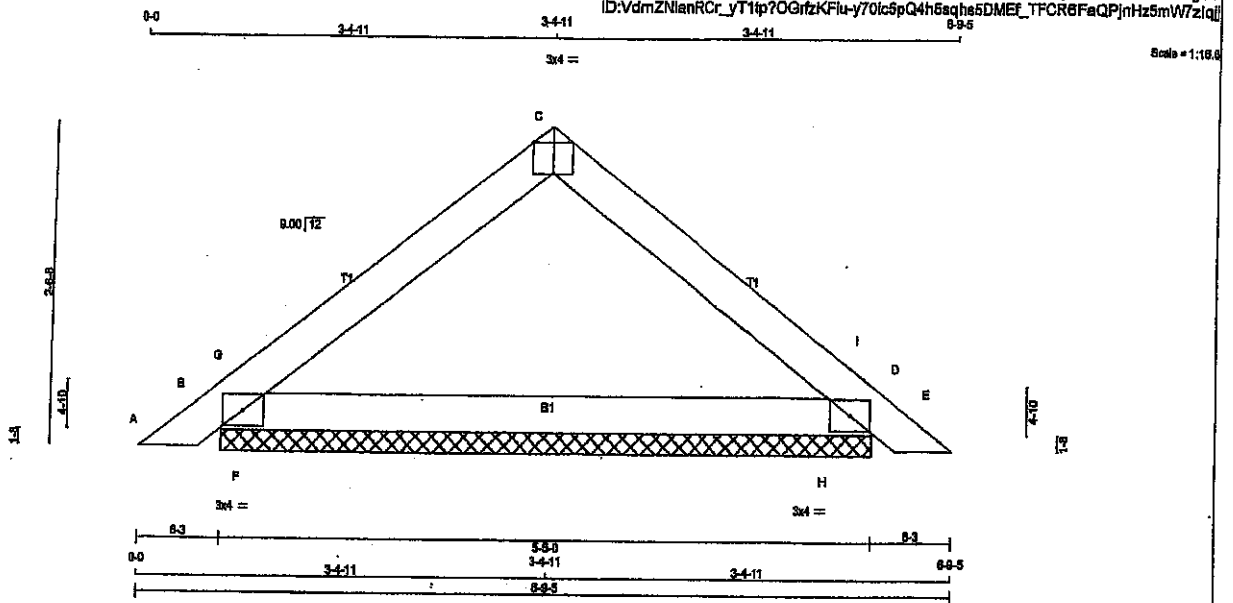

LUMBER	N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2			SPF
C - E	2x4 DRY	No.2			SPF
B - D	2x4 DRY	No.2			SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE				
B TMB1-J	MT20	3.0	4.0	
C TT-p	MT20	3.0	4.0	Edge 2.00
D TMB1-J	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	UP/LIFT		
B	441	0	441	0	5-5-0	5-5-0
D	441	0	441	0	5-5-0	5-5-0

UNFACTORED REACTIONS

1ST LOASE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
B	328	192/0	57/0	0/0	0/0	78/0	0/0
D	328	192/0	57/0	0/0	0/0	78/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLINE SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO			FR-TO		
A-B	0/17	-102.1 -102.1	0.03 (1)	10.00	F-G	0/330	0.00 (1)
B-G	-442/0	-102.1 -102.1	0.12 (3)	8.25	H-I	0/330	0.00 (1)
G-C	-235/0	-102.1 -102.1	0.15 (1)	8.25			
C-I	-235/0	-102.1 -102.1	0.15 (1)	8.25			
I-D	-442/0	-102.1 -102.1	0.12 (3)	8.25			
D-E	0/17	-102.1 -102.1	0.03 (1)	10.00			
B-F	0/201	-38.5 -38.5	0.09 (3)	10.00			
F-H	0/201	-38.5 -38.5	0.17 (2)	10.00			
H-D	0/201	-38.5 -38.5	0.09 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.1 PSF
DL = 8.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, NBCC 2012
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

CS1: TC=0.15H.00 (C-G1), BC=0.17H.00 (F-H2), WB=0.00H.00 (F-G1), SB=0.18H.00 (D-I3)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1887 788 1887 1888

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.28 (B) (INPUT = 0.80)
JSI METAL = 0.09 (B) (INPUT = 1.00)

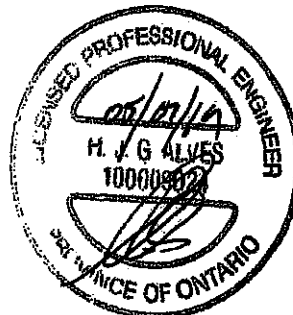

DRWG NO. TAM 171910758
STRUCTURAL
COMPONENT ONLY

JOB NAME

TRUSS NAME

QUANTITY

PLY

JOB DESC.

DRWG NO.

402981

V1

1

1

TRUSS DESC.

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 Mittek Industries, Inc. Wed May 8 15:15:42 2018 Page 1

ID:JIMS6RLJVLhc2snmluv9GyJDZW-Vyh5pyU1KQgo5Dj1pPFwxR6MhHkz0E_by9vSlazlXmV

Scale = 1:34.9

0-0

5-11-0

5-11-0

2-0-0

7-11-0

2-0-0

9-11-0

6-11-0

15-10-0

4x4

5-11-0

5-11-0

4-0-0

9-11-0

5-11-0

15-10-0

LUMBER

N.L.G.A. RULES

CHORDS

A - D

2x4

DRY

No.2

SPF

D - G

2x4

DRY

No.2

SPF

A - G

2x4

DRY

No.2

SPF

ALL WEBS

2x3

DRY

No.2

SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE

PLATES

W

LEN

Y

X

A TBM1-h

MT20

3.0

4.0

B C.E.F

C TMW+w

MT20

2.0

4.0

D TTW-p

MT20

4.0

4.0

2.25

2.00

G TBM1-h

MT20

3.0

4.0

H I J K L

H BMW1+w

MT20

2.0

4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
VERT	HORZ	DOWN	HORZ	UPLIFT
A	162	0	162	0
G	162	0	162	0
J	446	0	446	0
L	516	0	516	0
H	516	0	516	0
I	208	0	208	0
K	208	0	208	0

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	120	70/0	21/0	0/0	0/0	29/0	0/0
G	120	70/0	21/0	0/0	0/0	29/0	0/0
J	338	172/0	78/0	0/0	0/0	87/0	0/0
L	387	210/0	80/0	0/0	0/0	97/0	0/0
H	387	210/0	80/0	0/0	0/0	97/0	0/0
I	153	91/0	28/0	0/0	0/0	38/0	0/0
K	153	91/0	28/0	0/0	0/0	38/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, G, J, L, H, I, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)
MEMB.	FR-TO	FR-TO	FR-TO	FR-TO	MEMB.	FR-TO	FR-TO
A-N	0/91	-102.1	-102.1	0.05 (3)	10.00	J-D	-341/0
N-B	0/137	-102.1	-102.1	0.16 (1)	10.00	L-B	-325/0
B-C	0/106	-102.1	-102.1	0.16 (1)	10.00	H-F	-325/0
C-D	0/123	-102.1	-102.1	0.08 (1)	10.00	I-E	-188/0
D-E	0/123	-102.1	-102.1	0.08 (1)	10.00	K-C	-188/0
E-F	0/106	-102.1	-102.1	0.16 (1)	10.00	M-N	-111/44
F-P	0/137	-102.1	-102.1	0.16 (1)	10.00	O-P	-111/44
P-G	0/91	-102.1	-102.1	0.05 (3)	10.00		
A-M	-115/0	-38.5	-38.5	0.12 (1)	6.25		
M-L	-81/0	-38.5	-38.5	0.12 (1)	6.25		
L-K	-102/0	-38.5	-38.5	0.11 (2)	6.25		
K-J	-106/0	-38.5	-38.5	0.03 (2)	6.25		
J-I	-106/0	-38.5	-38.5	0.03 (2)	6.25		
I-H	-102/0	-38.5	-38.5	0.11 (2)	6.25		
H-O	-91/0	-38.5	-38.5	0.12 (1)	6.25		
O-G	-115/0	-38.5	-38.5	0.12 (1)	6.25		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 29.1 PSF

DL = 8.0 PSF

BOT CH. LL = 10.5 PSF

DL = 7.0 PSF

TOTAL DL = 52.5 PSF

SPACING = 24.0 IN.C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:


- PART 9 OF CBC 2016, OBC 2012

- CSA 088-08, CSA 088-14</

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
402981	V2	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.236 S Nov 17 2018 Mitek Industries, Inc. Wed May 8 15:15:43 2019 Page 1
ID: JIMS6RLJVLhc2smmluv9GyJDZW-z8FT0IV5kofNIEN7n9TefW_44QlckBpe?i4zlXmU

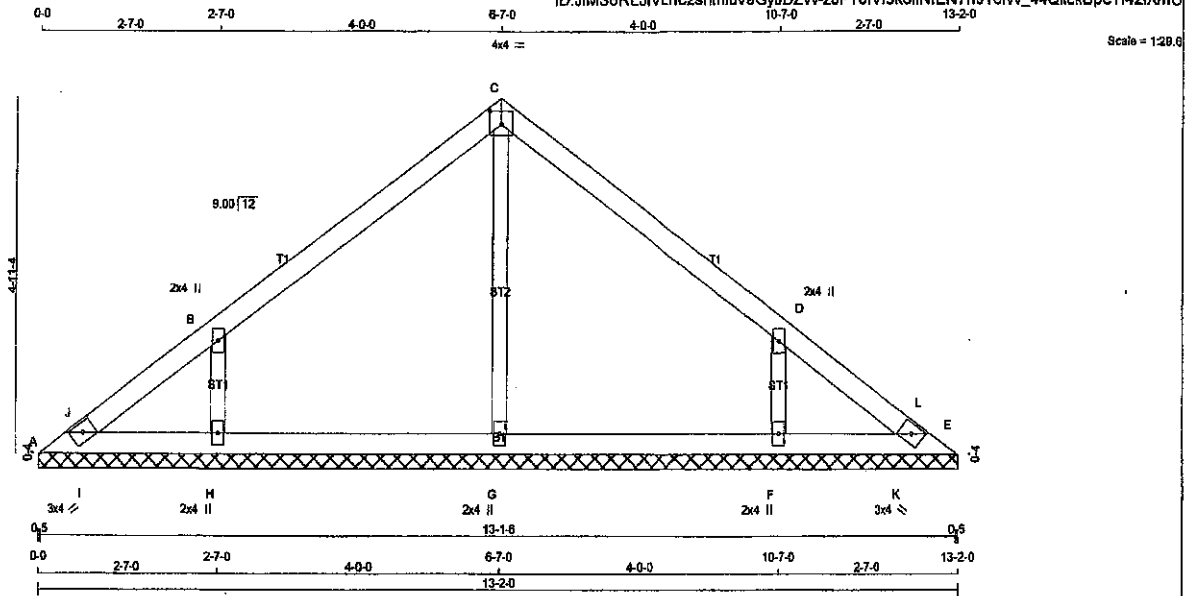

TOTAL WEIGHT = 38 lb

LUMBER	DESCR.
N. L. G. A. RULES	
CHORDS	
A - C	2x4 DRY No.2 SPF
C - E	2x4 DRY No.2 SPF
A - E	2x4 DRY No.2 SPF
ALL WEBS	2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.	

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE				
A TBM1-h	MT20	3.0	4.0	
B TMW1-w	MT20	2.0	4.0	
C TTW-p	MT20	4.0	4.0	2.25 2.00
D TMW1-w	MT20	2.0	4.0	
E TBM1-h	MT20	3.0	4.0	
F, G, H				
F BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	UPLIFT
A	137	0	137	0
E	137	0	137	0
G	427	0	427	0
H	572	0	572	0
F	572	0	572	0

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS	1ST CASE	MAX./MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
A	100	81/0 18/0 0/0 0/0 23/0 0/0
E	100	81/0 18/0 0/0 0/0 23/0 0/0
G	331	148/0 93/0 0/0 0/0 92/0 0/0
H	423	247/0 75/0 0/0 0/0 101/0 0/0
F	423	247/0 75/0 0/0 0/0 101/0 0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, G, H, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)
FR-TO		FROM TO		FR-TO		
A-J	-103/0	-102.1 -102.1	0.05 (1)	6.25	G-C	-266/0 0.09 (1)
J-B	-21/7	-102.1 -102.1	0.23 (1)	6.25	H-B	-435/0 0.08 (1)
B-C	-83/0	-102.1 -102.1	0.23 (1)	6.25	F-D	-435/0 0.08 (1)
C-D	-83/0	-102.1 -102.1	0.23 (1)	6.25	I-J	0/20 0.00 (1)
D-L	-21/7	-102.1 -102.1	0.23 (1)	6.25	K-L	0/20 0.00 (1)
L-E	-103/0	-102.1 -102.1	0.05 (1)	6.25		
A-I	0/70	-38.5 -38.5	0.03 (1)	10.00		
I-H	0/72	-38.5 -38.5	0.08 (2)	10.00		
H-G	0/47	-38.5 -38.5	0.10 (3)	10.00		
G-F	0/47	-38.5 -38.5	0.10 (3)	10.00		
F-K	0/72	-38.5 -38.5	0.08 (2)	10.00		
K-E	0/70	-38.5 -38.5	0.03 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.23/1.00 (B-C:1), BC=0.10/1.00 (G-H:3), WB=0.09/1.00 (C-G:1), SS=0.16/1.00 (B-C:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1686

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.31 (D) (INPUT = 0.90)
JSI METAL= 0.23 (B) (INPUT = 1.00)

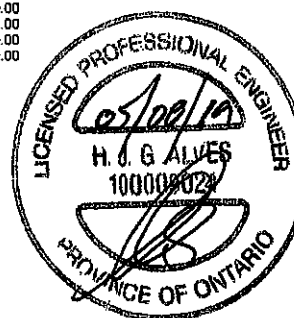

DRWING TAM 17910992
STRUCTURAL
0.0000000000

JOB NAME 402981	TRUSS NAME V3	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.230 S Nov 17 2018 MITek Industries, Inc. Wed May 8 15:15:44 2019 Page 1 ID:JIMS6RLJfVh2snmluv9GyJDZw-RKpsDeVHs2wWKKtQxqIO0aCfLUNfU7IuPTOZqXziXmIT	

Scale: 1/2"=1'

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF
B - C	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B	TTVW+p	MT20	4.0	4.0	2.25	2.00
C	TBM1-h	MT20	3.0	4.0		
D	BMV1+w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
A	15	0	15	0	10-5-8	10-5-8
C	15	0	15	0	10-5-8	10-5-8
D	1439	0	1439	0	10-5-8	10-5-8

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX/MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	12	4/0	4/0	0/0	0/0	4/0	0/0
C	12	4/0	4/0	0/0	0/0	4/0	0/0
D	1074	598/0	211/0	0/0	0/0	264/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS						WEBS						
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED L1 (LBS)	MAX. CS1 (LBS)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LBS)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LBS)
A-F	0/570	-102.1	-102.1	0.22 (1)	10.00	D-B	-1094/0	0.26 (1)	10.00	E-F	-318/29	0.00 (1)
F-B	0/551	-102.1	-102.1	0.38 (1)	10.00	G-H	-318/29	0.00 (1)	10.00			
B-H	0/551	-102.1	-102.1	0.38 (1)	10.00							
H-C	0/570	-102.1	-102.1	0.22 (1)	10.00							
A-E	-507/0	-38.5	-38.5	0.24 (1)	6.25							
E-D	-451/0	-38.5	-38.5	0.30 (1)	6.25							
D-G	-451/0	-38.5	-38.5	0.30 (1)	6.25							
G-C	-507/0	-38.5	-38.5	0.24 (1)	6.25							

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 29.1 PSF
DL = 8.0 PSF

BOT CH. LL = 10.5 PSF
DL = 7.0 PSF

TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012
- CSA 088-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.38/1.00 (B-F:1), BC=0.30/1.00 (D-E:1), WB=0.26/1.00 (B-D:1), SS=0.18/1.00 (A-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1687

MAX MIN MAX MIN MAX MIN

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.79 (B) (INPUT = 0.90)
JSI METAL= 0.25 (B) (INPUT = 1.00)

**THIS STRUCTURE MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE PROVISIONS OF
THE ONTARIO BUILDING CODE**

DATE: 05/09/19
DRAWN BY: TAM
CHECKED BY: J79/0993
CONTRACTOR
NOT FOR CONSTRUCTION

Tamarack Roof Truss, Burlington



DRY: SEASONED LUMBER.

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

TOTAL WEIGHT = 10 X 17 = 310 lb

FACTORED		MAXIMUM FACTORED		INPUT	RECORD
GROSS REACTION		GROSS REACTION		BRG	BRG
ST	VERT	DOWN	HORIZ	IN-SX	IN-SX
C	648	648	0	5-8	5-8
E	228	228	0	1-8	1-8
D	93	119	0	1-3	1-8

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	473	292 / 0	72 / 0	0 / 0	0 / 0	109 / 0	0 / 0
C	134	128 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0
D	85	0 / 0	51 / 0	0 / 0	0 / 0	34 / 0	0 / 0

BRACING


TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 6.25 FT.
MAX. UNRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

TOTAL LOAD CASES: (4)

CHORDS				WEBBS			
MEMB.	MAX FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (L)	MAX. UNBRAC LENGTH (FT)	MEMB.	MAX FACTORED FORCE (LBS)	MAX CSI (L)
FR-TO		FROM TO			FR-TO		
E-9	-514 / 0	0.0	0.0	0.22 (3)	7.81		
A-B	0 / 31	-102.1	-102.1	0.13 (1)	10.00		
B-C	-34 / 0	-102.1	-102.1	0.60 (1)	8.25		
E-D	0 / 0	-38.5	-38.5	0.22 (3)	10.00		

DWG NO. TAM 71910753
STRUCTURAL
COMPONENT ONLY

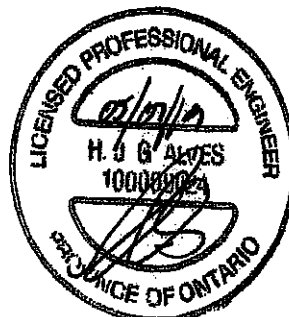


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
402979	J4	3	1	TRUSS DESC.		

Tamareck Roof Truss, Burlington

Version 8.230 8 Nov 17 2018 Mitek Industries, Inc. Wed May 8 18:07:55 2019 Page 1

ID: JPMXDERQ69GD5IO853aPwyJEZ-g8zYoHr5Jxq3ZSWHzqNPVYHmRM363BsZ7HEsCzIXlo

Scale = 1:17.7

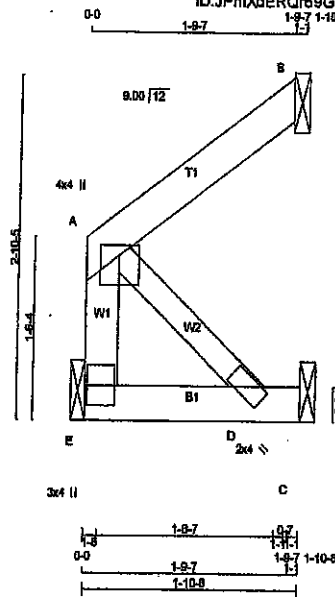

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - A	2x4	DRY	No.2
A - B	2x4	DRY	No.2
E - C	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW+p	MT20	4.0	4.0	1.00 2.00
D	BMW+w	MT20	2.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONAL, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
E	127	0	127	0	0	1-8	1-8	1-8	1-8
B	91	0	91	0	0	1-8	1-8	1-8	1-8
C	36	0	46	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B37821H FOR CONNECTION TO JOINT(S) E, B, C

UNFACTORED REACTIONS		1ST LCASE		MAX/MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
E	85	52/0	20/0	0/0	0/0
B	63	52/0	0/0	0/0	0/0
C	33	0/0	20/0	0/0	0/0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT.	LC1	MAX	MAX.	MEMB.	FORCE (LBS)	MAX	MAX.
FR-TO		FROM	TO	CS1 (LC)	UNBRAC	FR-TO		FROM	TO
E-A	-91/0	0.0	0.0	0.01 (1)	7.81	A-D	0/0	0.00 (1)	
A-B	0/0	-102.1	-102.1	0.08 (1)	10.00				
E-D	0/0	-38.5	-38.5	0.03 (3)	10.00				
D-C	0/0	-38.5	-38.5	0.02 (3)	10.00				

TOTAL WEIGHT = 3 X 8 = 23 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.1 PSF
DL = 8.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, CBC 2012
- CSA 089-09, CSA 089-14
- TPIC 2011, TPIC 2014

(55 % OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/860 (0.16")
CALCULATED VERT. DEFL. (LL) = L/989 (0.00")
ALLOWABLE DEFL. (TL) = L/860 (0.16")
CALCULATED VERT. DEFL. (TL) = L/989 (0.00")

CSI: TC=0.08/1.00 (A-B-1), BC=0.03/1.00 (D-E-3),
WB=0.00/1.00 (A-D-1), SS=0.08/1.00 (A-B-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1857 788 1857 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.07 (A) (INPUT = 0.80)
JSI METAL= 0.02 (A) (INPUT = 1.00)

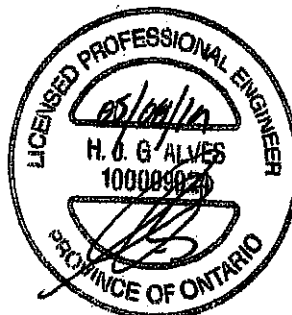


DWG NO. TAM 7910974
STRUCTURAL
COMPONENT ONLY

JOB NAME 402979	TRUSS NAME J5	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	-------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.230 8 Nov 17 2018 Mitek Industries, Inc. Wed May 8 15:07:56 2019 Page 1
ID: JPMXdeRQr68GDSIO853aPwyJEIZ-8IXw7drk4FywBc5UWYue29plRqgdqVQ?of0oCfzIXm

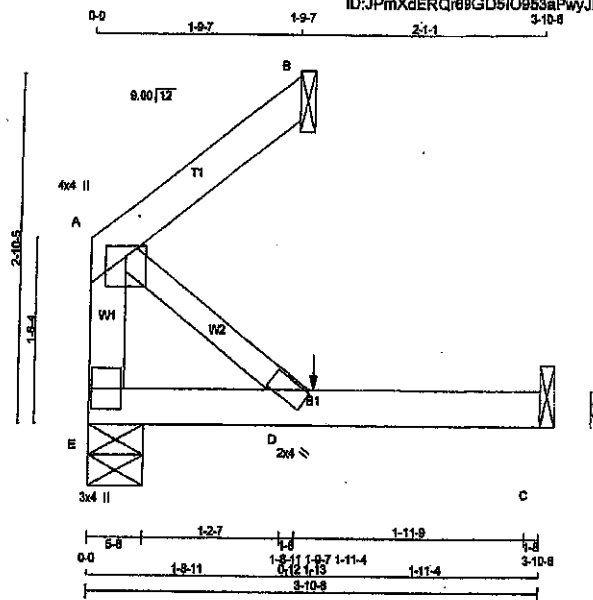

Scale = 1:17.5

TOTAL WEIGHT = 10 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - A	2x4	DRY	No.2	SPF
A - B	2x4	DRY	No.2	SPF
E - C	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
D	BMVW+w	MT20	2.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
E	185	0	185	0	5-8	5-8		
B	91	0	91	0	1-8	1-8		
C	75	0	95	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B37821H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

JT	1ST CASE		MAX/MIN COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERMLIVE			
E	130	92/0	41/0	0/0	0/0	38/0	0/0
B	63	92/0	0/0	0/0	0/0	11/0	0/0
C	68	0/0	41/0	0/0	0/0	27/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		
E-A	-91/0	0.0 0.0 0.01 (1)	7.81	0/0
A-B	0/0	-102.1 -102.1 0.06 (1)	10.00	0.00 (1)
E-D	0/0	-38.5 -38.5 0.14 (2)	10.00	
D-C	0/0	-38.5 -38.5 0.14 (2)	10.00	

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR	TYPE	HEEL	CONN.
D	1-11-4	1	1		BACK	VERT	TOTAL		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.1 PSF
DL = 8.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(65 % OF 37.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.18")
CALCULATED VERT. DEFL.(LL) = 1/889 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.18")
CALCULATED VERT. DEFL.(TL) = 1/889 (0.02")

CSI: TC=0.08/1.00 (A-B-1), BC=0.14/1.00 (C-D-2),
WB=0.00/1.00 (A-D-1), SB=0.08/1.00 (D-E-2)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PL)	(PL)
	MAX	MIN	MAX
MT20	610	354	1987 758 1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.07 (A) (INPUT = 0.80)
JSI METAL= 0.02 (A) (INPUT = 1.00)

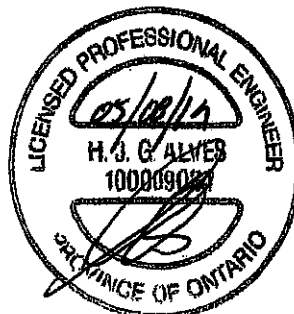

DRWG NO. TAM 71910975
STRUCTURAL
COMPONENT ONLY

JOB NAME 402979	TRUSS NAME J6	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.230 5 Nov 17 2018 MITek Industries, Inc. Wed May 8 15:07:56 2019 Page 1 ID:JpMxIdERQ69GD5IO953aPwyJEIZ-8IXw7dk4FywBc5UWYue29pfqesqVQ7of0aOfzIXm		

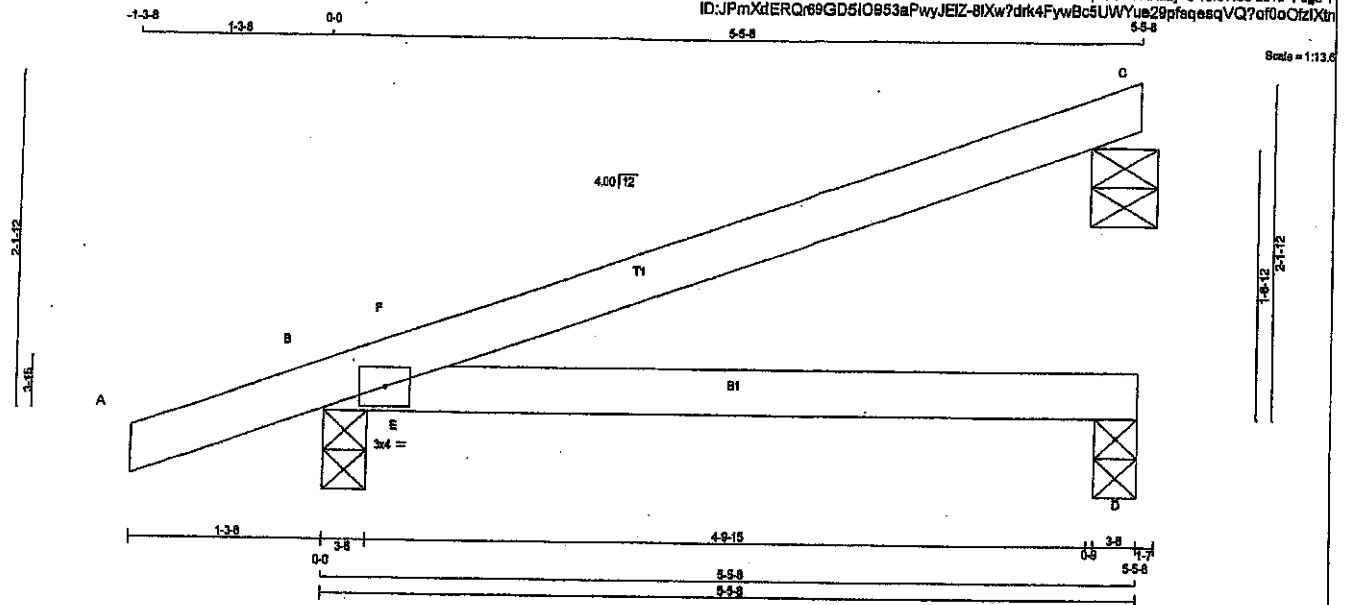

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
B - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.
GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table is in inches)			
JT TYPE	PLATES	W	LEN Y X
B	TMB-1	MT20	3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0/20	-102.1 -102.1	0.13 (1)	E-F	-254/122	0.00 (1)	
B-F	-51/0	-102.1 -102.1	0.13 (3)				
F-C	0/6	-102.1 -102.1	0.42 (1)				
B-E	0/0	-38.5 -38.5	0.25 (1)				
E-D	0/0	-38.5 -38.5	0.31 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. GC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/842 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/469 (0.13")

CSI: TO=0.42/1.00 (C-F:1), BC=0.31/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SB=0.28/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	
MT20	818	354	1987 788 1987 1856

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.31 (B) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)

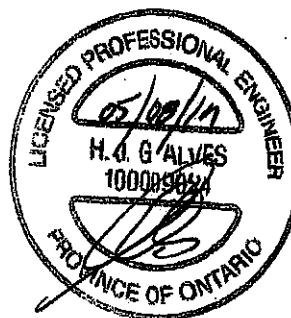

DWG NO. TAM 119/0976
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
402981	J20	2	1	TRUSS DESC.		
Tamarack Roof Truss, Burlington						Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Wed May 8 16:15:35 2018 Page 1
						ID: JIMS6RLJVLhc2anmluv9GyJDZV-CbmSLZPe_Hool8hvrRdH8yK29sLBH53ZLaia0YzIXmc

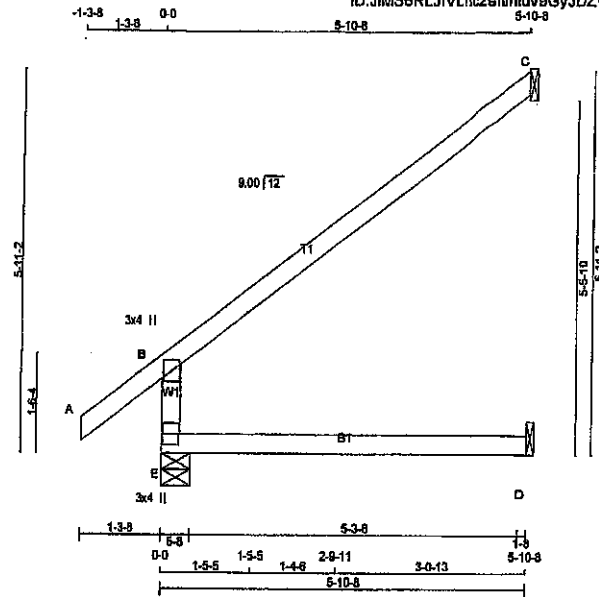

TOTAL WEIGHT = 2 X 18 = 37 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0			
E	BMV+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

	FACTORED		MAXIMUM FACTORED		INPUT	REQRD
	GROSS REACTION		GROSS REACTION		BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
E	575	0	575	0	0	5-8
C	225	0	225	0	0	1-8
D	43	0	49	0	0	1-8

SEE MITEK STANDARD DETAIL B37821H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	COMBINED						
E	401	293/0	0/0	0/0	0/0	108/0	0/0
C	154	128/0	0/0	0/0	0/0	28/0	0/0
D	35	0/0	0/0	0/0	0/0	35/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS			WEBS		
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FROM	TO	LENGTH	FR-TO
E-B	-516/0	0.0	0.0	0.11 (4)	7.81
A-B	0/42	-102.1	-102.1	0.14 (1)	10.00
B-C	-45/0	-102.1	-102.1	0.80 (1)	6.25
E-D	0/0	-17.5	-17.5	0.13 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.1 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 42.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.80/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS=0.23/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN	MAX
MT20	818	354	1887	788

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.24 (B) (INPUT = 0.80)
JSI METAL= 0.18 (B) (INPUT = 1.00)




DRWG NO. TAM 17910983
STRUCTURAL
CHECK ONLY

JOB NAME 402981	TRUSS NAME J21	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.230 5 Nov 17 2018 M/Tek Industries, Inc. Wed May 8 15:15:38 2019 Page 1
ID: JIMS6RLJfVLhc2snmluv9GyJDZW-gokQYvQGlaWeNIGuT99VhAkJPGemcYJiaES8Y_zlXmb

Scale = 1/25.3

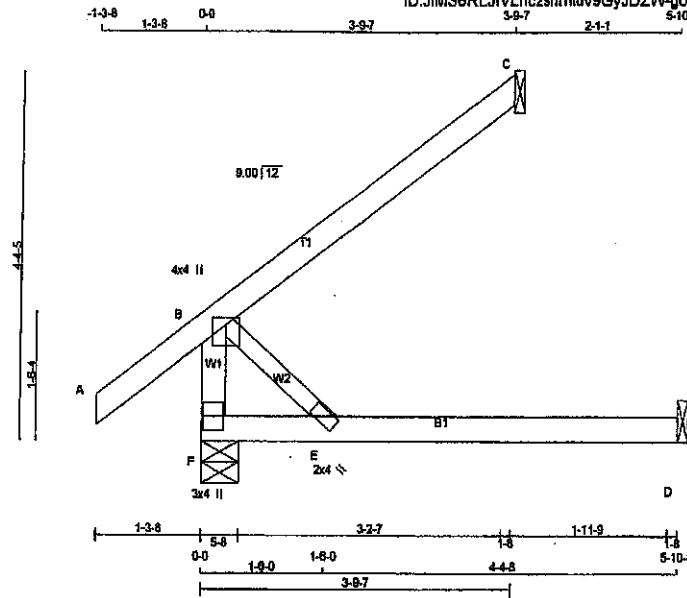

TOTAL WEIGHT = 17 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
E	BMVW+w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	RECORD
	VERT	HORZ	DOWN	HORZ	UPLIFT
JT	447	0	447	0	0
F	193	0	193	0	0
C	113	0	144	0	0

SEE MITEK STANDARD DETAIL B37821H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	332	180 / 0	62 / 0	0 / 0	80 / 0	0 / 0
F	133	110 / 0	0 / 0	0 / 0	23 / 0	0 / 0
D	103	0 / 0	62 / 0	0 / 0	41 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. (PLF)	CS1 (LC)	UNBRAC	LENGTH	FR-TO	FORCE (LBS)	MAX CS1 (LC)
FR-TO		FROM TO						
F-B	-334 / 0	0.0	0.0	0.03 (1)	7.81	B-E	0 / 0	0.00 (1)
A-B	0 / 42	-102.1	-102.1	0.14 (1)	10.00			
B-C	0 / 0	-102.1	-102.1	0.25 (1)	10.00			
F-E	0 / 0	-38.5	-38.5	0.23 (3)	10.00			
E-D	0 / 0	-38.5	-38.5	0.30 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/925 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/555 (0.13")

CS1: TC=0.25/1.00 (B-C:1), BC=0.30/1.00 (D-E:3), WB=0.00/1.00 (B-E:1), SS=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(FSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 768

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.27 (B) (INPUT = 0.80)
JSI METAL= 0.07 (B) (INPUT = 1.00)

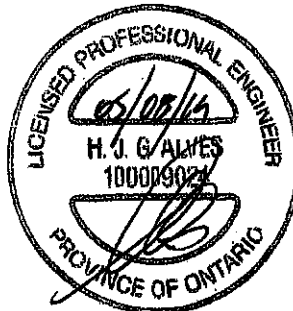


DRWG NO. TAM 17910984
STRUCTURAL
CONSTRUCTION ONLY

JOB NAME 402981	TRUSS NAME J22	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Wed May 8 15:15:38 2019 Page 1
ID:JIMS8RLJfV/Lhc2snmluv9GyJDZW-goKqYvQGlaweNIGuT99VhAtKwGeScYJlaES8Y_zlXmb

Scale = 1:17.7

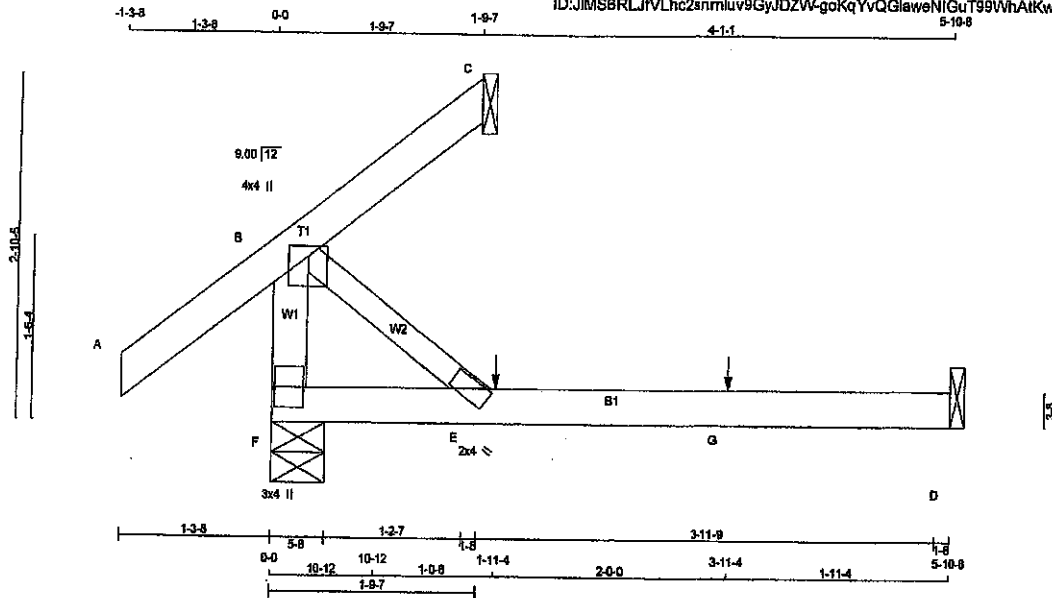

TOTAL WEIGHT = 14 lb

LUMBER

N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
E	BMVW+p	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
F	400	0	400	0	5-8	5-8
C	37	0	37	0	1-8	1-8
D	113	0	144	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37821H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	288	163/0	62/0	0/0	0/0	75/0	0/0
C	25	21/0	0/0	0/0	0/0	4/0	0/0
D	103	0/0	62/0	0/0	0/0	41/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		MAX. FACTORED	MEMB.	WEBS		MAX. FACTORED
	FORCE (LBS)	VERT. LOAD (LBS)	PLF	CSI (LC)			FORCE (LBS)	MAX. FACTORED	
FR-TO						FR-TO			
F-B	-288/0	0.0	0.0	0.03 (1)	7.81	B-E	0/0	0.00 (1)	
A-B	0/42	-102.1	-102.1	0.15 (1)	10.00				
B-C	-33/0	-102.1	-102.1	0.15 (1)	6.25				
F-E	0/0	-38.5	-38.5	0.26 (2)	10.00				
E-G	0/0	-38.5	-38.5	0.32 (2)	10.00				
G-D	0/0	-38.5	-38.5	0.32 (2)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	1-11-4	1	1	1	FRONT	VERT	TOTAL		
G	3-11-4	1	1	1	FRONT	VERT	TOTAL		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/925 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/555 (0.13")

CSI: TC=0.15/1.00 (A-B:1), BC=0.32/1.00 (D-E:2), WB=0.09/1.00 (B-E:1), SS=0.12/1.00 (E-F:2)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1657 768	1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.23 (B) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)

THIS STRUCTURE MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE PROVISIONS OF
THE ONTARIO BUILDING CODE

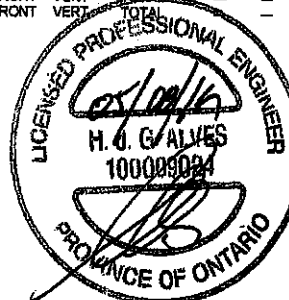


DWG NO. TAM 17910785
STRUCTURAL
CONSULTANT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
402981	J24	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 6.230 9 Nov 17 2018 MTEK Industries, Inc. Wed May 8 15:15:37 2019 Page 1
ID: JMS6RLJVLhc2snmluv9GyJDZW-9_uCIFRuWu2V_Sr41sglENPU8g26L7YsotBh4QzIXma

Scale = 1:25.0

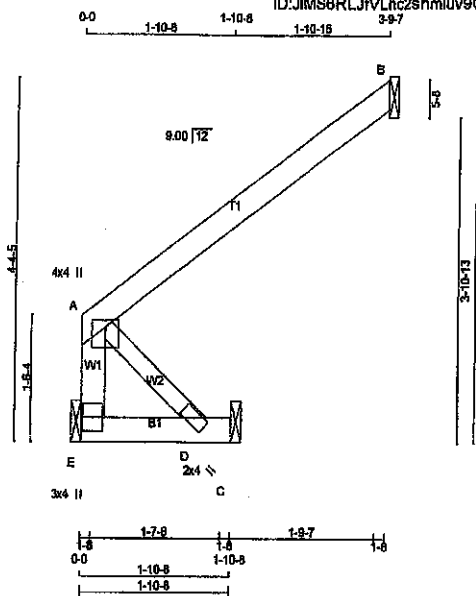

TOTAL WEIGHT = 10 lb (M/F)

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - A	2x4	DRY	No.2	SPF
A - B	2x4	DRY	No.2	SPF
E - C	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMW+p	MT20	4.0	4.0	1.00	2.00
D	BMW+w	MT20	2.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
E	229	0	229	0
B	193	0	193	0
C	36	0	48	0

SEE MITEK STANDARD DETAIL B37821H FOR CONNECTION TO JOINT(S) E, B, C

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	166	110 / 0	20 / 0	0 / 0	0 / 0	38 / 0	0 / 0
B	133	110 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0
C	33	0 / 0	20 / 0	0 / 0	0 / 0	13 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 MAX (PLF)	CS1 (LC) UNBRAC LENGTH FR-TO	MEMB. FORCE (LBS)
FR-TO				
E-A	-183 / 0	0.0	0.0	0.02 (1)
A-B	0 / 0	-102.1	-102.1	0.25 (1)
E-D	0 / 0	-38.5	-38.5	0.03 (3)
D-C	0 / 0	-38.5	-38.5	0.02 (3)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.1 PSF
DL = 8.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/889 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/889 (0.00")

CS1: TC=0.25/1.00 (A-B:1), BC=0.03/1.00 (D-E:3), WB=0.00/1.00 (A-D:1), SB=0.12/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1987 768 1987 1858

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.15 (A) (INPUT = 0.90)
JSI METAL= 0.04 (A) (INPUT = 1.00)

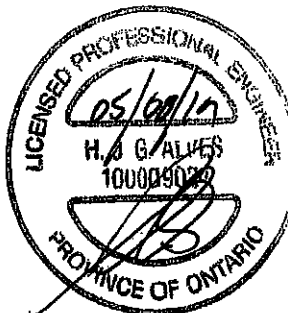

DRWG NO. TAM 17910986
STRUCTURAL
CHECK SHEET ONLY





isDesign™

Client:
Project:
Address:Date: 5/7/2019
Designer:
Job Name: 201007
Project #:

Page 1 of 4

BM1 S-P-F #2 2.000" X 10.000" 2-Ply - PASSED

Level: Level

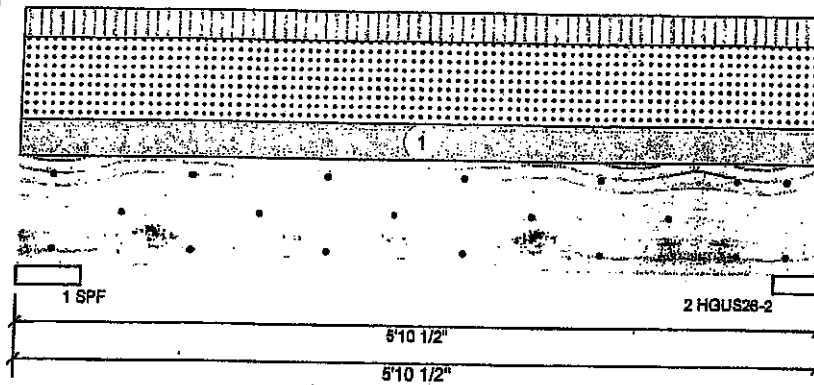**Member Information**

Type: Girder
Plies: 2
Moisture Condition: Dry
Deflection LL: 380
Deflection TL: 380
Importance: Normal

Application: Roof (Residential)
Slope: 0/12
Design Method: LSD
Building Code: NBCC 2015
Load Sharing: No
Deck: Not Checked
Vibration: Not Checked

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Live	Dead	Snow	Wind
1	207	257	583	0
2	199	246	558	0

Bearings and Factored Reactions


Bearing	Length	Cap. React D/L lb	Total Ld. Case	Ld. Comb.
1 - SPF	5.500'	14% 321 / 1081	1402 L	1.25D+1.5S +L
2 - HGUS...	4.000'	18% 308 / 1036	1344 L	1.25D+1.5S +L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	1685 ft-lb	3'	8039 ft-lb	0.262 (26%)	1.25D+1.5S +L	L
Unbraced	1685 ft-lb	3'	6236 ft-lb	0.303 (30%)	1.25D+1.5S +L	L
Shear	1217 lb	1'2"	3984 lb	0.306 (31%)	1.25D+1.5S +L	L
LL Defl inch	0.014 (L/4487)	3'	0.174 (L/380)	0.080 (8%)	S+0.5L	L
TL Defl inch	0.019 (L/3273)	3'	0.174 (L/380)	0.110 (11%)	D+S+0.5L	L

Design Notes

- 1 Fasten all plies using 3 rows of Pneumatic Gun Nail (.120x3.25") at 12" o.c. Maximum end distance not to exceed 6".
- 2 Refer to last page of calculations for fasteners required for specified loads.
- 3 Girders are designed to be supported on the bottom edge only.
- 4 Top braced at bearings.
- 5 Bottom braced at bearings.
- 6 Lateral slenderness ratio based on single ply width.

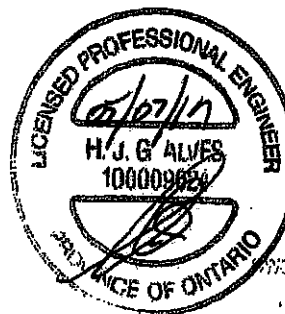

17910792
STRUCTURAL
100009654

1/2

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Uniform		6-7-0	Near Face	13 PSF	10.5 PSF	28.5 PSF	0 PSF	

Manufacturer Info

Tamarack Roof Trusses
3289 North Service Rd., ON
Canada
L7N3G2
(805) 335-1115



This design is valid until 12/11/2021





isDesign™



Client:
Project:
Address:

Date: 5/7/2019
Designer:
Job Name: 201007
Project #:

Page 2 of 4

BM1 S-P-F #2 2.000" X 10.000" 2-Ply - PASSED



Level: Level

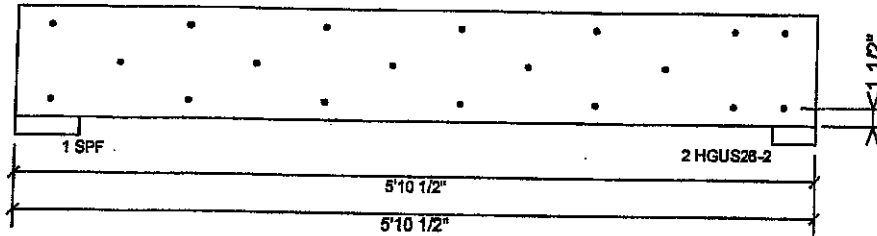

Multi-Ply Analysis

Fasten all plies using 3 rows of Pneumatic Gun Nail (.120x3.25") at 12" o.c. Maximum end distance not to exceed 6"

Capacity	88.7 %
Load	233.7 PLF
Yield Limit per Foot	340.0 PLF
Yield Limit per Fastener	113.3 lb.
Yield Mode	0
Edge Distance	1 1/2"
Min. End Distance	3"
Load Combination	1.25D+1.5S+L
Duration Factor	1.00

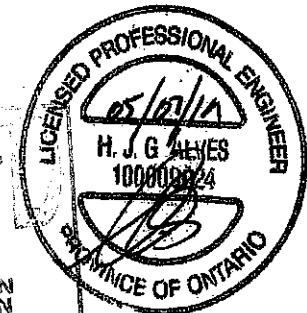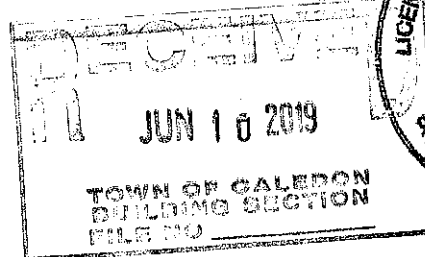

ENGINEER 1910792
STRUCTURAL
CONF. 05/07/19

Manufacturer Info

Tamarack Roof Trusses
3286 North Service Rd., ON
Canada
L7N3G2
(905) 338-1115



This design is valid until 12/11/2021







isDesign™

Client:
Project:
Address:Date: 5/8/2019
Designer:
Job Name: 402979
Project #:

Page 1 of 4

BM2 S-P-F #2 2.000" X 10.000" 2-Ply - PASSED

Level: Level

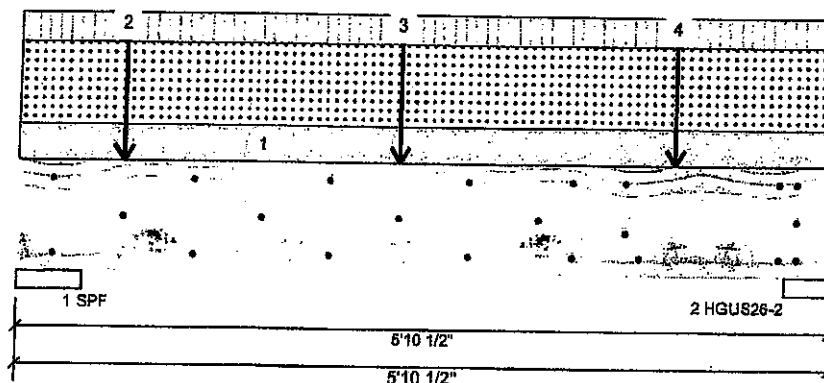**Member Information**

Type:	Girder	Application:	Roof (Residential)
Piles:	2	Slope:	0/12
Moisture Condition:	Dry	Design Method:	LSD
Deflection LL:	360	Building Code:	NBCC 2015
Deflection TL:	360	Load Sharing:	No
Importance:	Normal	Deck:	Not Checked
		Vibration:	Not Checked

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Live	Dead	Snow	Wind
1	155	203	456	0
2	180	233	523	0

Bearings and Factored Reactions

Bearing	Length	Cap. React D/L lb	Total	Ld. Case	Ld. Comb.
1 - SPF	5.500"	11%	254 / 839	1093 L	1.25D+1.5S +L
2 - HGUS...	4.000"	17%	291 / 964	1255 L	1.25D+1.5S +L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	1791 ft-lb	2'9"	6039 ft-lb	0.297 (30%)	1.25D+1.5S +L	L
Unbraced	1791 ft-lb	2'9"	5238 ft-lb	0.342 (34%)	1.25D+1.5S +L	L
Shear	1217 lb	4'10"	3984 lb	0.305 (31%)	1.25D+1.5S +L	L
LL Defl Inch	0.014 (L/4361)	3'	0.174 (L/360)	0.080 (8%)	S+0.5L	L
TL Defl Inch	0.020 (L/3157)	3'	0.174 (L/360)	0.110 (11%)	D+S+0.5L	L

Design Notes

- 1 Fasten all plies using 3 rows of Pneumatic Gun Nail (.120x3.25") at 12" o.c. Maximum end distance not to exceed 6".
- 2 Refer to last page of calculations for fasteners required for specified loads.
- 3 Concentrated load fastener specification is in addition to hanger fasteners if a hanger is present.
- 4 Girders are designed to be supported on the bottom edge only.
- 5 Top braced at bearings.
- 6 Bottom braced at bearings.
- 7 Lateral slenderness ratio based on single ply width.



DATE: 05/08/19

DESIGNER: TAM

100009024

1/2

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Uniform		2-0-0	Near Face	13 PSF	10.5 PSF	28.5 PSF	0 PSF	
2	Point	0-9-0		Far Face	24 lb	20 lb	52 lb	0 lb	j4
3	Point	2-9-0		Far Face	157 lb	110 lb	352 lb	0 lb	t15c
4	Point	4-9-0		Far Face	102 lb	82 lb	228 lb	0 lb	t15

Manufacturer Info

Tamarack Roof Trusses

3288 North Service Rd., ON

Canada


L7N3G2

(905) 335-1115



This design is valid until 12/11/2021






isDesign™

Client:
Project:
Address:Date: 5/8/2019
Designer:
Job Name: 402979
Project #:

Page 2 of 4

BM2 S-P-F #2 2.000" X 10.000" 2-Ply - PASSED

Level: Level

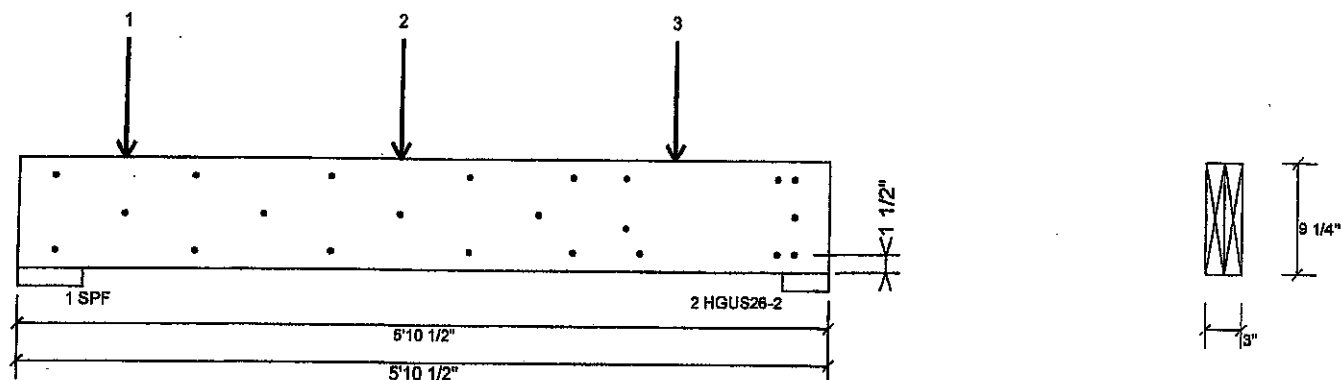**Multi-Ply Analysis**



Fasten all plies using 3 rows of Pneumatic Gun Nail (.120x3.25") at 12" o.c. except for regions covered by concentrated load fastening. Maximum end distance not to exceed 6"

Capacity	20.9 %
Load	71.0 PLF
Yield Limit per Foot	340.0 PLF
Yield Limit per Fastener	113.3 lb.
Yield Mode	g
Edge Distance	1 1/2"
Min. End Distance	3"
Load Combination	1.25D+1.5S+L
Duration Factor	1.00

Concentrated Load

Fasten at concentrated side load at 4-9-0 with a minimum of (3) - Pneumatic Gun Nail (.120x3.25") in the pattern shown.

Capacity	81.1 %
Load	275.8 lb.
Total Yield Limit	340.0 lb.
Yield Limit per Fastener	113.3 lb.
Yield Mode	g
Load Combination	1.25D+1.5S+L
Duration Factor	1.00

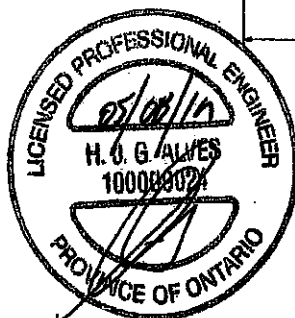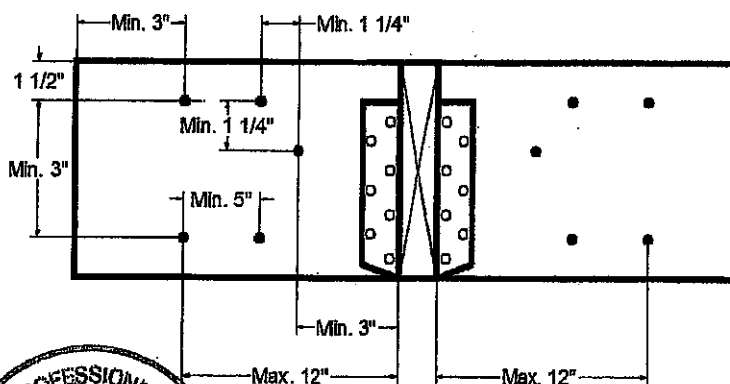Min/Max fastener distances for Concentrated Side Loads

DATE: 5/8/2019
DRAWN BY: JAM
CHECKED BY: JAM
DESIGNED BY: JAM
PROJECT: 402979
SHEET: 2/2

Manufacturer Info

Tamarack Roof Trusses
3289 North Service Rd., ON
Canada
L7N3G2
(905) 835-1115



This design is valid until 12/11/2021






isDesign™

Client:
Project:
Address:Date: 5/8/2019
Designer:
Job Name: 402979
Project #:

Page 3 of 4

BM3 S-P-F #1 2.000" X 10.000" 2-Ply - PASSED

Level: Level

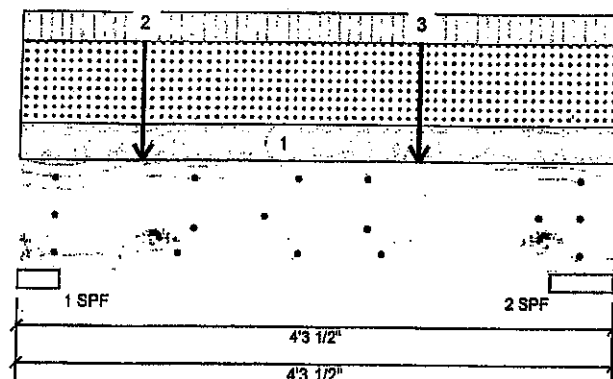**Member Information**

Type: Girder
 Piles: 2
 Moisture Condition: Dry
 Deflection LL: 360
 Deflection TL: 360
 Importance: Normal

Application: Roof (Residential)
 Slope: 0/12
 Design Method: LSD
 Building Code: NBCC 2015
 Load Sharing: No
 Deck: Not Checked
 Vibration: Not Checked

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Live	Dead	Snow	Wind
1	143	184	430	0
2	127	159	380	0

Bearings and Factored Reactions

Bearing	Length	Cap. React D/L lb	Total Ld. Case	Ld. Comb.
1 - SPF	3.500"	16%	230 / 788	1018 L 1.25D+1.5S +L
2 - SPF	5.600"	9%	198 / 687	866 L 1.25D+1.5S +L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	769 ft-lb	2'4 5/8"	8039 ft-lb	0.127 (13%)	1.25D+1.5S +L	L
Unbraced	769 ft-lb	2'4 5/8"	5641 ft-lb	0.136 (14%)	1.25D+1.5S +L	L
Shear	985 lb	1'	3984 lb	0.247 (25%)	1.25D+1.5S +L	L
LL Defl inch	0.004 (L/12347)	2'7/8"	0.122 (L/360)	0.030 (3%)	S+0.5L	L
TL Defl inch	0.005 (L/8004)	2'7/8"	0.122 (L/360)	0.040 (4%)	D+S+0.5L	L

Design Notes

- 1 Fasten all plies using 3 rows of Pneumatic Gun Nail (.120x3.25") at 12" o.c. Maximum end distance not to exceed 6".
- 2 Refer to last page of calculations for fasteners required for specified loads.
- 3 Concentrated load fastener specification is in addition to hanger fasteners if a hanger is present.
- 4 Girders are designed to be supported on the bottom edge only.
- 5 Top braced at bearings.
- 6 Bottom braced at bearings.
- 7 Lateral slenderness ratio based on single ply width.



DWG NO. TAM 11910995
 STRUCTURAL
 1/2

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Uniform		2-0-0	Near Face	13 PSF	10.5 PSF	29.5 PSF	0 PSF	
2	Point	0-10-8		Far Face	121 lb	81 lb	291 lb	0 lb	
3	Point	2-10-8		Far Face	110 lb	89 lb	248 lb	0 lb	

Manufacturer Info

Tamarack Roof Trusses
 3259 North Service Rd., ON
 Canada
 L7N3G2
 (905) 335-1115



This design is valid until 12/11/2021





isDesign™


Client:
Project:
Address:

Date: 5/8/2019
Designer:
Job Name: 402979
Project #:

Page 4 of 4

BM3 S-P-F #1 2.000" X 10.000" 2-Ply - PASSED

Level: Level

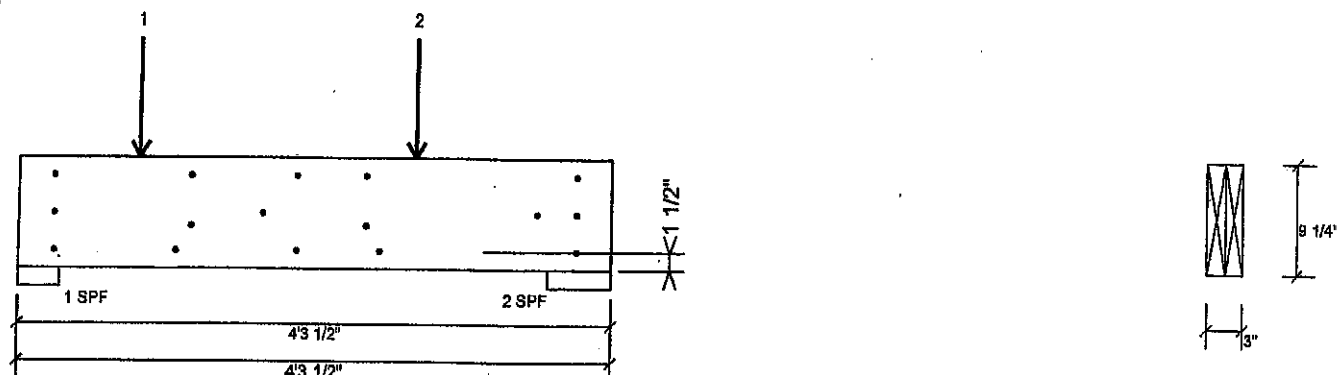

Multi-Ply Analysis

Fasten all plies using 3 rows of Pneumatic Gun Nail (.120x3.25") at 12" o.c. except for regions covered by concentrated load fastening. Maximum end distance not to exceed 6"

Capacity	20.9 %
Load	71.0 PLF
Yield Limit per Foot	340.0 PLF
Yield Limit per Fastener	113.3 lb.
Yield Mode	g
Edge Distance	1 1/2"
Min. End Distance	3"
Load Combination	1.25D+1.5S+L
Duration Factor	1.00

Concentrated Load

Fasten at concentrated side load at 0-10-8 with a minimum of (3) - Pneumatic Gun Nail (.120x3.25") in the pattern shown.



Capacity	99.8 %
Load	339.4lb.
Total Yield Limit	340.0 lb.
Yield Limit per Fastener	113.3 lb.
Yield Mode	g
Load Combination	1.25D+1.5S+L
Duration Factor	1.00

Concentrated Load

Fasten at concentrated side load at 2-10-8 with a minimum of (3) - Pneumatic Gun Nail (.120x3.25") in the pattern shown.

Capacity	87.6 %
Load	297.8lb.
Total Yield Limit	340.0 lb.
Yield Limit per Fastener	113.3 lb.
Yield Mode	g
Load Combination	1.25D+1.5S+L
Duration Factor	1.00

Min/Max fastener distances for Concentrated Side Loads

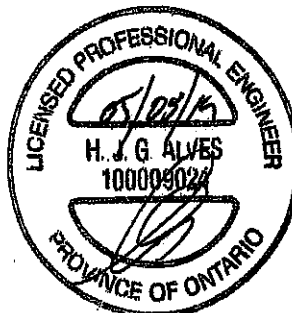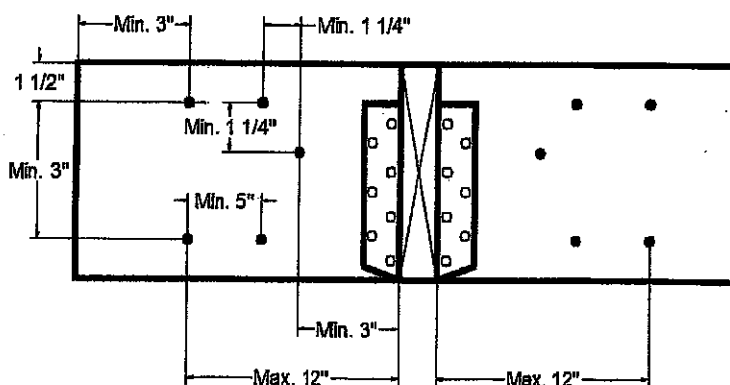

THIS IS NOT A
STRUCTURAL
DESIGN ONLY 2/2

Manufacturer Info

Tamarack Roof Trusses
3289 North Service Rd., ON
Canada
L7N3G2
(800) 335-1115




This design is valid until 12/11/2021

Overview:

Where piggybacks are connected ovetop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

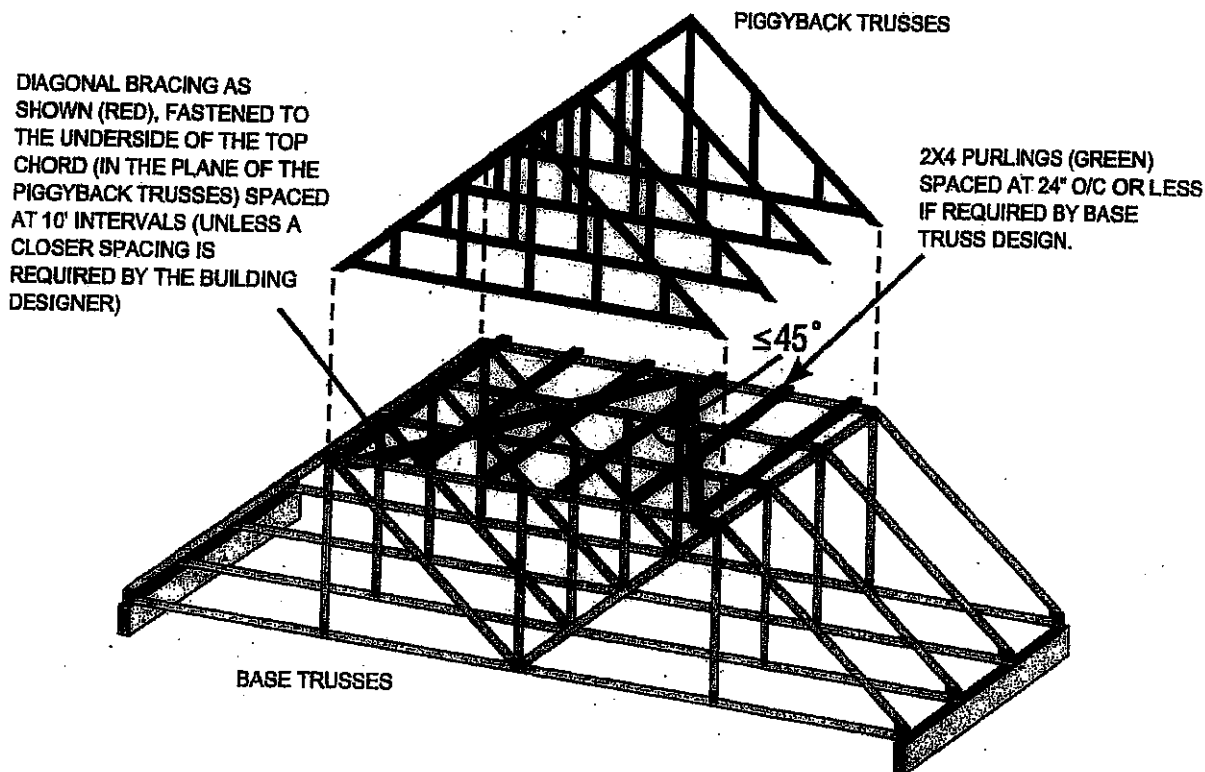


NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.

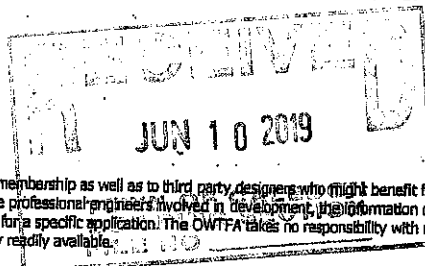

LUS - Double Shear Joist Hangers

SIMPSON
Strong-Tie

All LUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections.

Material: 18 gauge


Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:

- Use all specified fasteners.
- Nails: 16d = 0.162" dia. x 3 1/2" long common wire, 10d = 0.148" x 3" long common wire.
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads.
- Not designed for welded or nailer applications.




Typical LUS Installation

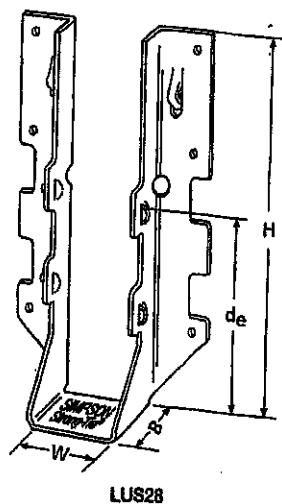

LUS28


Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d _o ¹	Face	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _o =1.15)	(K _o =1.00)	(K _o =1.15)	(K _o =1.00)
LUS24	18	1 1/2	3 1/2	1 1/2	1 1/4	(4) 10d	(2) 10d	710	1630	645	1155
LUS24-2	18	3 1/2	3 1/2	2	1 1/4	(4) 16d	(2) 16d	835	2020	590	1435
LUS26	18	1 1/2	4 1/2	1 1/2	3 1/2	(4) 10d	(4) 10d	1420	2170	1290	1630
LUS26-2	18	3 1/2	4 1/2	2	4	(4) 16d	(4) 16d	1720	2595	1545	1920
LUS26-3	18	4 1/2	4 1/2	2	3 1/4	(4) 16d	(4) 16d	1720	2595	1545	2340
LUS28	18	1 1/2	6 1/2	1 1/2	3 1/2	(6) 10d	(6) 10d	1420	2520	1290	1790
LUS28-2	18	3 1/2	7	2	4	(6) 16d	(4) 16d	1720	3325	1545	2575
LUS28-3	18	4 1/2	6 1/2	2	3 1/4	(6) 16d	(4) 16d	1720	3325	1545	2375
LUS210	18	1 1/2	7 1/2	1 1/2	3 1/2	(6) 10d	(4) 10d	1420	2785	1290	2210
LUS210-2	18	3 1/2	9	2	6	(6) 16d	(6) 16d	2580	4500	2320	3195
LUS210-3	18	4 1/2	8 1/2	2	5 1/4	(6) 16d	(6) 16d	2580	3345	2320	2375

1. d_o is the distance from the seat of the hanger to the highest joist nail.




Double Shear Nailing prevents tabs breaking off (available on some models).

U.S. Patent 5,603,580



Double Shear Nailing Top View.

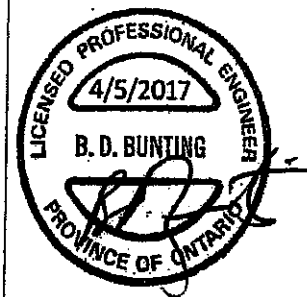

(800) 999-5099
strongtie.com

HUS/LJS -- Double Shear Joist Hangers

SIMPSON
Strong-Tie

All hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

Material: See table

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners
- Nails: 16d = 0.162" dia. x 3 1/2" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

Options:


- See current catalogue for options




LJS26DS




HUS210
(HUS26, HUS28, similar)



Typical LJS26DS
Installation




Typical HUS
Installation




Typical HUS Installation
(Truss Designer to provide fastener
quantity for connecting multiple
members together)

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d _a	Face	Joist	D.Fk-L		S-P-F	
								Uplift (K _u =1.15)	Normal (K _n =1.00)	Uplift (K _u =1.15)	Normal (K _n =1.00)
LJS26DS	18	1 1/8	5	3 1/2	4 1/8	(16) 16d	(6) 16d	2055	4265	1460	4115
HUS26	16	1 1/8	5 1/2	3	3 1/8	(14) 16d	(6) 16d	2705	4940	2065	3875
HUS28	16	1 1/8	7 1/2	3	6 1/2	(22) 16d	(8) 16d	3805	5365	2875	4345
HUS210	16	1 1/8	8 1/2	3	7 1/2	(30) 16d	(10) 16d	4505	5795	4010	4740
HUS1.81/10	16	1 1/8	9	3	8	(30) 16d	(10) 16d	4505	6450	4010	5200


1. d_a is the distance from the seat of the hanger to the highest joist nail.




Double Shear Nailing prevents tabs breaking off (available on some models).
U.S. Patent 5,803,580



Double Shear Nailing Side View. Do not bend tab back.



Double Shear Nailing Top View.

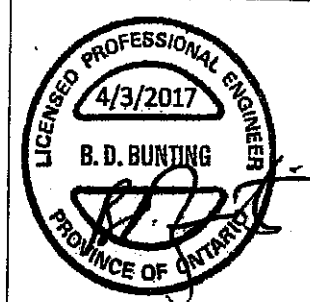

(800) 999-5099
strongtie.com

HGUS - Double Shear Joist Hangers

SIMPSON
Strong-Tie

All HGUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

Material: 12 gauge

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%.
No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners
- Nails: 16d = 0.162" dia x 3 1/2" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

Options:


- See current catalogue for options



HGUS28-2

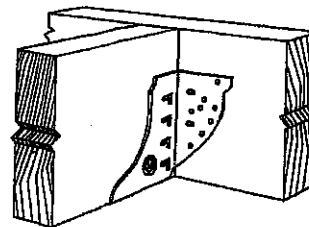


Typical HGUS
Installation




Typical HGUS
Installation
(Truss Designer to
provide fastener
quantity for
connecting multiple
members together)

Model No.	Ga.	Dimensions (in.)					Fasteners		Factored Resistance (lb.)			
		W	H	B	d ₁		Face	Joist	D.Fir-L		S-P-F	
									Uplift (K ₁ =1.15)	Normal (K ₂ =1.00)	Uplift (K ₁ =1.15)	Normal (K ₂ =1.00)
HGUS26	12	1 1/8	5 1/8	5	4 1/2	(20) 16d	(8) 16d		2685	6625	2685	5700
HGUS26-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d		4385	8950	3100	6355
HGUS26-3	12	4 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d		4385	8950	3100	6355
HGUS26-4	12	6 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d		4385	8950	3100	6355
HGUS28	12	1 1/8	7 1/8	6	8 1/8	(36) 16d	(12) 16d		3310	7675	3100	6900
HGUS28-2	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d		6070	12980	4310	9215
HGUS28-3	12	4 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d		6070	12980	4310	9215
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d		6070	12980	4310	9215
HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d		6840	14645	4855	10400
HGUS210-3	12	4 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d		6840	14645	4855	10400
HGUS210-4	12	6 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d		6840	14645	4855	10400
HGUS212-4	12	8 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d		7640	14895	5425	10645
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d		10130	16400	7185	11645


1. d₁ is the distance from the seat of the hanger to the highest joist nail.




Dome Double
Shear Nailing
prevents tabs
breaking off
(available on
some models).
U.S. Patent
5,603,580




Double
Shear
Nailing
Side View.
Do not
bend tab
back.



Double
Shear
Nailing
Top View.

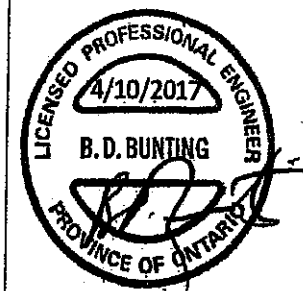

(800) 999-5099
strongtie.com

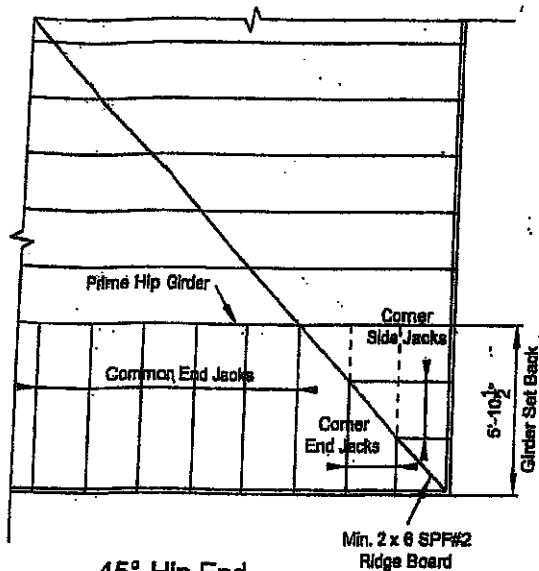

45° Hip End



LUMBER SPECIFICATION

TOP CHORD : 2 x 4 SPF#2
 BOTTOM CHORD : 2 x 4 SPF#2
 WEBS : 2 x 3 SPF#2
 UNLESS OTHERWISE SHOWN


DESIGN LOAD

TOP CHORD SNOW LOAD : 40.5 P.S.F.
 TOP CHORD DEAD LOAD : 3.0 P.S.F.
 BOTTOM CHORD LIVE LOAD : 0.0 P.S.F.
 BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.


TOTAL LOAD : 50.5 P.S.F

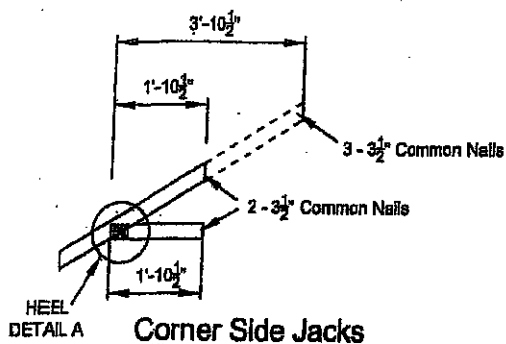


Corner Side Jacks

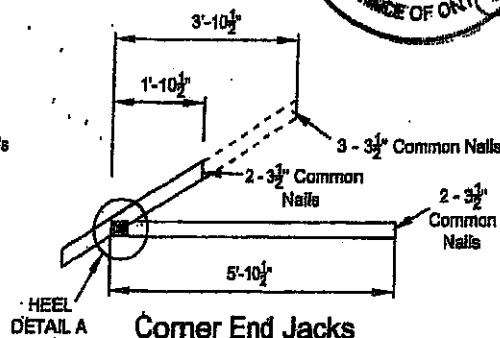

Corner End Jacks

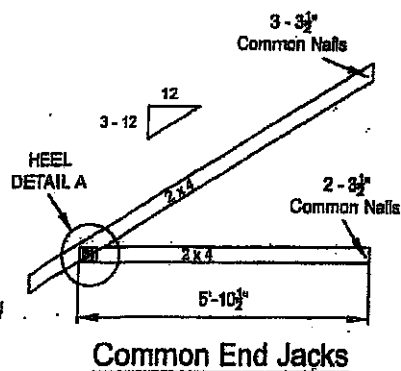


Common End Jacks

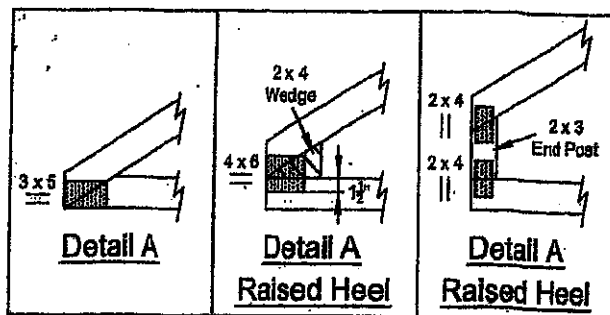

NOTE: DESIGN CONFORMS TO PART 9, O.B.C. 2012 (L.S.D. DESIGN)

T-1800216

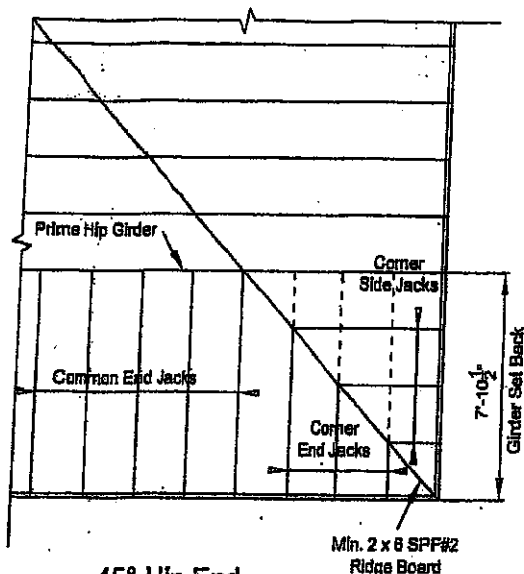

45° Hip End



LUMBER SPECIFICATION

TOP CHORD : 2 x 4 SPF#2
 BOTTOM CHORD : 2 x 4 SPF#2
 WEBS : 2 x 3 SPF#2
 UNLESS OTHERWISE SHOWN


DESIGN LOAD

TOP CHORD SNOW LOAD : 40.5 P.S.F.
 TOP CHORD DEAD LOAD : 3.0 P.S.F.
 BOTTOM CHORD LIVE LOAD : 0.0 P.S.F.
 BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.


TOTAL LOAD

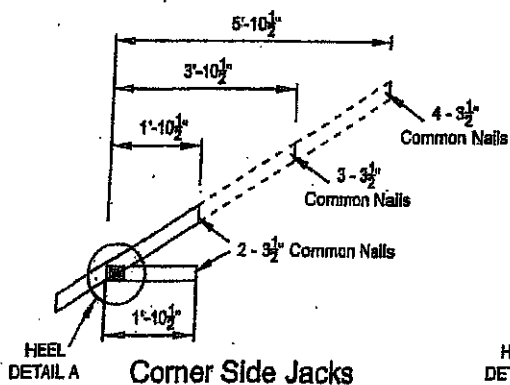


Corner Side Jacks

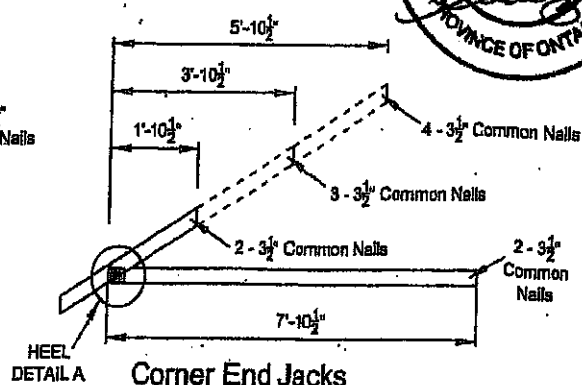


Corner End Jacks

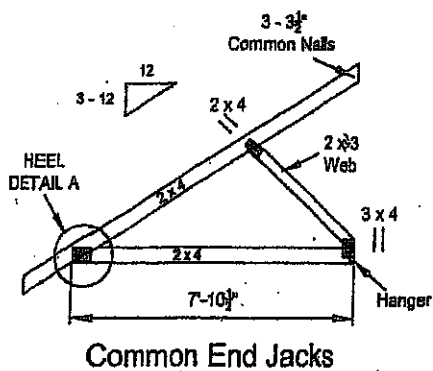

Common End Jacks

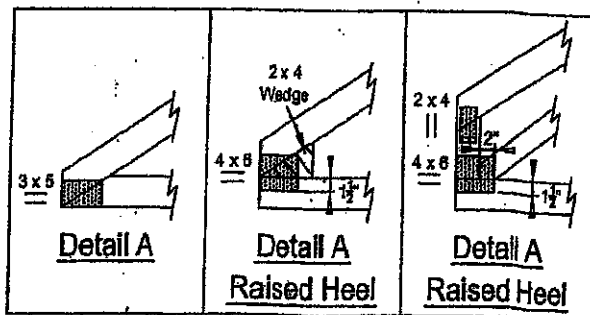

NOTE: DESIGN CONFORMS TO PART 8, O.B.C. 2012 (L.S.D. DESIGN)

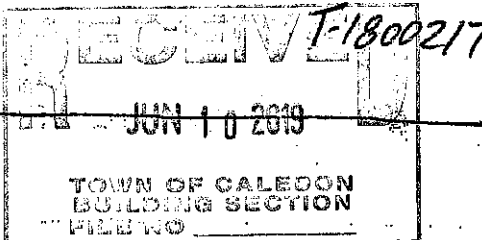


Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in 1/16ths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/8" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.

Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

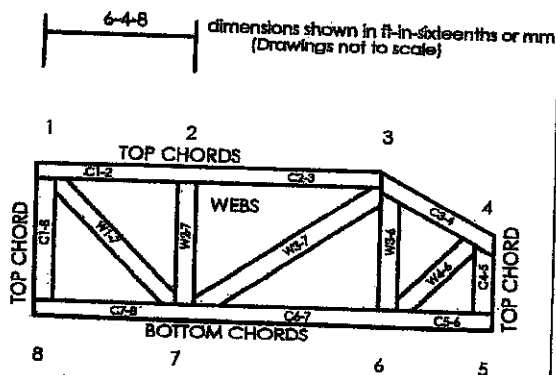

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MI-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for Information on symbols, numbering system and General Safety notes.

THIS STRUCTURE MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE PROVISIONS OF
THE ONTARIO BUILDING CODE

T-1300218

Feb 09, 2018