



THIS STRUCTURE MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE REQUIREMENTS OF
THE CURRENT BUILDING CODE

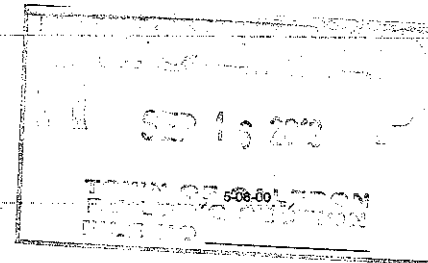

URBAN 1
FRONT ELEV -2A
UNIT 86-3
LOWES HILL CIRCLE
405512

URBAN 12
FRONT ELEV -2
UNIT 86-4
LOWES HILL CIRCLE
405513

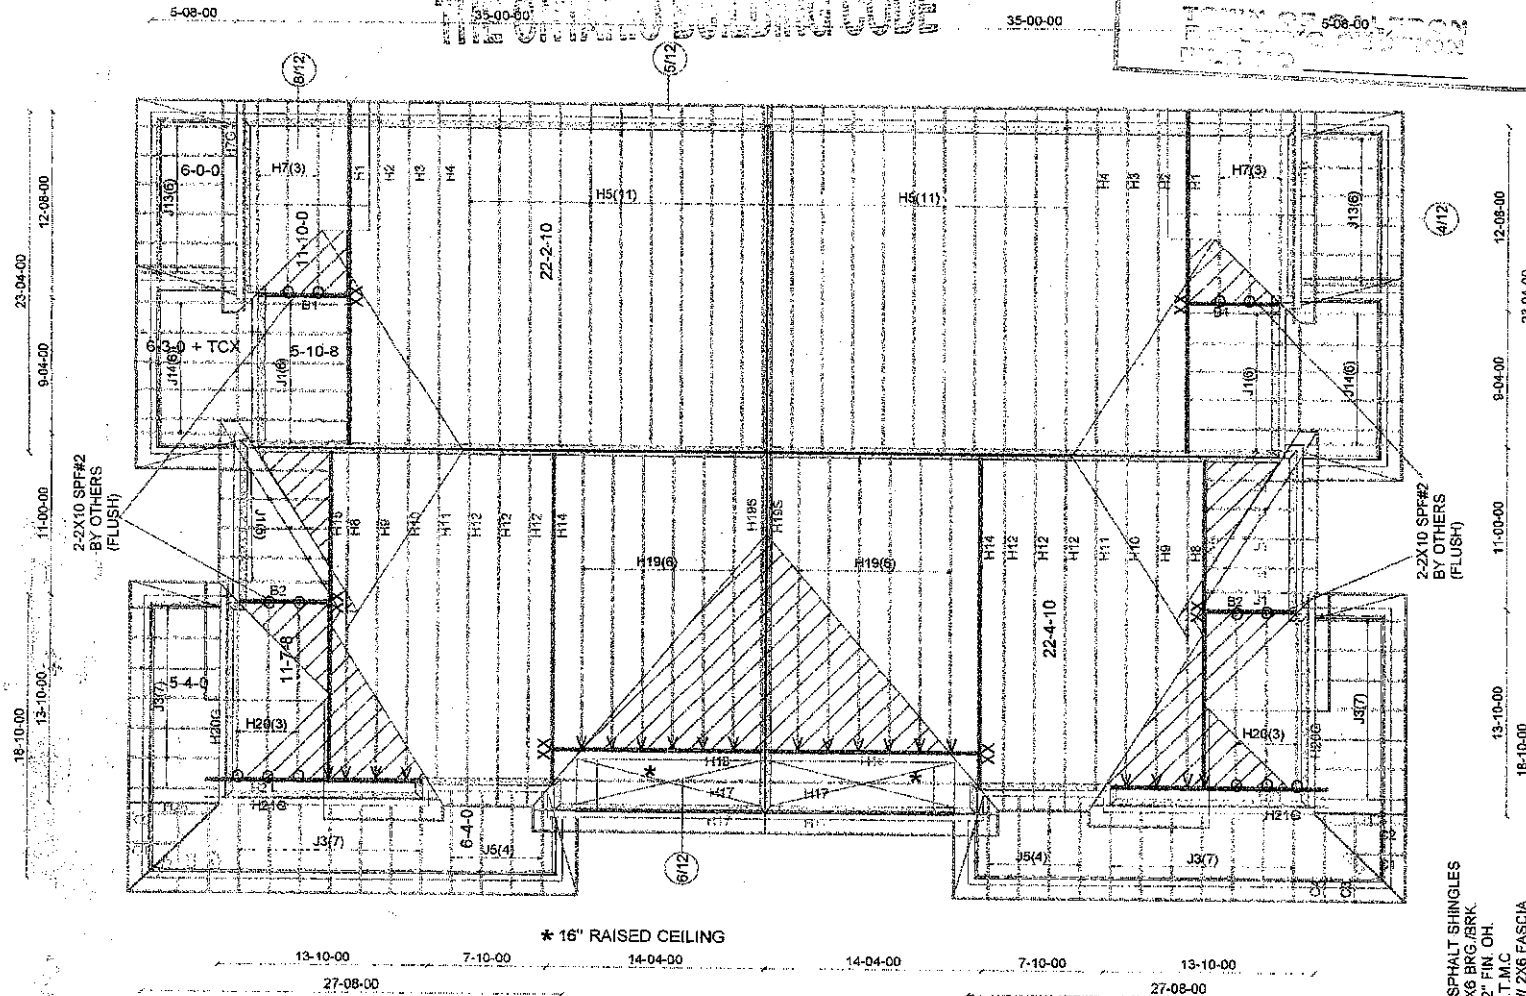

HARDWARE:
LUS24 - (O)
LUS26DS - (V)
HGUS26-2 - (XX)

URBAN 1
FRONT ELEV -2A
UNIT 86-2
LOWES HILL CIRCLE
405512

URBAN 12
FRONT ELEV -2
UNIT 86-1
LOWES HILL CIRCLE
405513

A COMPLETE SET OF REVIEWED DRAWINGS &
SPECIFICATIONS MUST BE KEPT ON SITE AT ALL TIMES
DURING CONSTRUCTION AS PER O.B.C.

APPLICANT COPY

Job Track: **50033**
Plan Log: **201713**
Layout ID: **405511**

Builder / Location:
GREEN PARK HOMES / CALEDON

Project: **LAMBERT LANE PH.2**

Date: 9/13/2019 Sales: Mario DiCano Designer: AC


Model / Elevation:

BLOCK 86 / UNITS 86-1 - 86-4

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

Mitek ver 8.3.0.234

URBAN 1 REV01 - REVISION TO ROOF SLOPE INCLUSION OF TRUSS LAYOUT FOR BLOCK 83

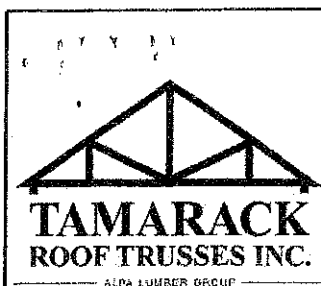


DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: LAMBERT LANE PH.2
 Location: CALEDON
 Model: BLOCK 86
 Lot #:
 Elevation: UNITS 86-1, 86-4

Job Track: 50033
 Plan Log: 201713
 Layout ID: 405513
 Ref #:
 Page: 1 of 2
 Date: 09/10/2019
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	H8 Half Hip	5/12	22-00-02	5-03-13	2 x 4		1-02-07 5-03-13	87.8 55.33		
	1	H9 Half Hip	5/12	22-00-02	6-07-13	2 x 4		1-02-07 6-07-13	94.89 61.17		
	1	H10 Half Hip	5/12	22-00-02	7-11-13	2 x 4		1-02-07 7-11-13	96.28 60.83		
	1	H11 Half Hip	5/12	22-04-10	9-03-13	2 x 4		1-00-09 9-03-13	103.89 65.17		
	3	H12 Monopitch	5/12	22-04-10	10-04-08	2 x 4	1-03-08	1-00-09 10-04-08	298.43 183.50		
	1 2-ply	H14 Monopitch Girder	5/12	22-04-10	10-04-08	2 x 4 2 x 6		1-00-09 10-04-08	244.78 150.33		
	1 2-ply	H15 Hip Girder	5/12	22-00-02	5-03-13	2 x 4 2 x 6		1-02-07 1-03-10	201.49 129.33		
	2	H17 Monopitch Structural Gable	6/12 12/12	13-08-10	8-00-05	2 x 4		1-02-00 6-08-05	115.24 77.33		
	1 2-ply	H18 Jack-Closed Girder	6/12	13-08-10	8-00-05	2 x 4 2 x 6		1-02-00 8-00-05	141.36 88.00		
	6	H19 Common	5/12	19-09-08	10-04-08	2 x 4		2-01-09 10-04-08	531.48 330.00		
	1	H19S GABLE	5/12	18-09-08	10-04-08	2 x 4		2-06-09 10-04-08	101.77 64.33		
	3	H20 Common	8/12	11-07-08	5-08-13	2 x 4		1-04-13 2-03-13	144.13 95.00		
	1	H20G GABLE	8/12	11-07-08	5-08-13	2 x 4	1-03-08	1-04-13 2-03-13	52.6 34.33		
	1 2-ply	H21 Common Girder	8/12	13-00-00	5-08-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	137.09 85.67		

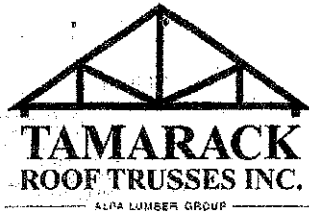

DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: LAMBERT LANE PH.2
 Location: CALEDON
 Model: BLOCK 86
 Lot #:
 Elevation: UNITS 86-1, 86-4

Job Track: 50033
 Plan Log: 201713
 Layout ID: 405513
 Ref #
 Page: 2 of 2
 Date: 09/10/2019
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	H21G GABLE	8 / 12	13-00-00	5-08-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	57.01 36.33		
	1	H26 Monopitch Girder	4 / 12	4-07-00	2-03-03	2 x 4	1-03-08	7-15 2-02-04	17.84 12.67		
	5	J1 Jack-Open	8 / 12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	89.15 53.33		
	14	J3 Jack-Open	4 / 12	5-04-00	2-06-03	2 x 4	1-03-08	7-15 2-02-04	206.9 149.33		
	4	J5 Jack-Open	4 / 12	6-04-00	2-10-03	2 x 4	1-03-08	7-15 2-06-04	68.48 48.00		

TOTAL # TRUSS= 53

TOTAL BFT OF ALL TRUSSES= 1779.98

BFT.


TOTAL WEIGHT OF ALL TRSSES 2790.61 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
5	Hardware	LUS24	
10	Hardware	LJS26DS	
2	Hardware	HGUS26-2	

TOTAL NUMBER OF
ITEMS=

17

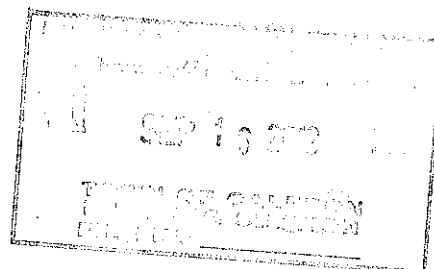



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: LAMBERT LANE PH.2
 Location: CALEDON
 Model: BLOCK 86
 Lot #:
 Elevation: UNITS 86-2, 86-3

Job Track: 50033
 Plan Log: 201713
 Layout ID: 405512
 Ref #
 Page: 1 of 1
 Date: 09/13/2019
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	H1 Half Hip Girder	5/12	22-02-10	5-03-13	2 x 4 2 x 6	1-03-08	1-00-09 5-03-13	219.48 135.00		
	1	H2 Half Hip	5/12	22-02-10	6-07-13	2 x 4	1-03-08	1-00-09 6-07-13	96.92 62.50		
	1	H3 Half Hip	5/12	22-02-10	7-11-13	2 x 4	1-03-08	1-00-09 7-11-13	98.18 61.67		
	1	H4 Half Hip	5/12	22-02-10	9-03-13	2 x 4	1-03-08	1-00-09 9-03-13	105.08 66.50		
	11	H5 Monopitch	5/12	22-02-10	10-03-10	2 x 4	1-03-08	1-00-09 10-03-10	1086.42 672.83		
	3	H7 Common	8/12	11-10-00	5-04-02	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	157.12 95.60		
	1	H7G GABLE	8/12	11-10-00	5-04-02	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	48.73 30.83		
	6	J1 Jack-Open	8/12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	106.98 64.00		
	6	J13 Jack-Open	4/12	6-00-00	2-08-14	2 x 4	1-03-08	7-15 2-04-15	98.04 64.00		
	6	J14 Jack-Closed	4/12	6-03-00	3-00-14	2 x 4	1-03-08	7-15 2-08-15	166.79 119.00		

TOTAL # TRUSS= 38


TOTAL BFT OF ALL TRUSSES= 1371.83 BFT.

TOTAL WEIGHT OF ALL TRSSES 2183.74 LBS


HARDWARE

QTY	TYPE	MODEL	LENGTH
2	Hardware	LUS24	
1	Hardware	HGUS26-2	

TOTAL NUMBER OF
ITEMS= 3

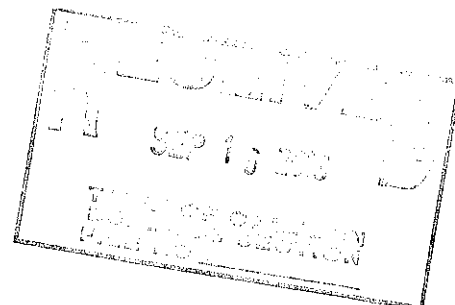

JOB NAME 405481	TRUSS NAME H1	QUANTITY 2	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.300 5 May 10 2019 Mitek Industries, Inc. File Sep 13 12:21:51 2019 Page 1			
1-3-8 0-0 5-2-12 5-2-12 5-0-4 10-3-0 3-11-15 14-2-15 3-10-11 18-1-11 2-5-3 20-6-14 1-7-12 22-2-10		ID: CGPEwIRwz3f2cd8UHFyFR8a-6bVNIcPINLd2x0QR2M3IT7GsvyqPOXh17C6Uvrye3DU			
Scale = 1/32" = 1'-0"					

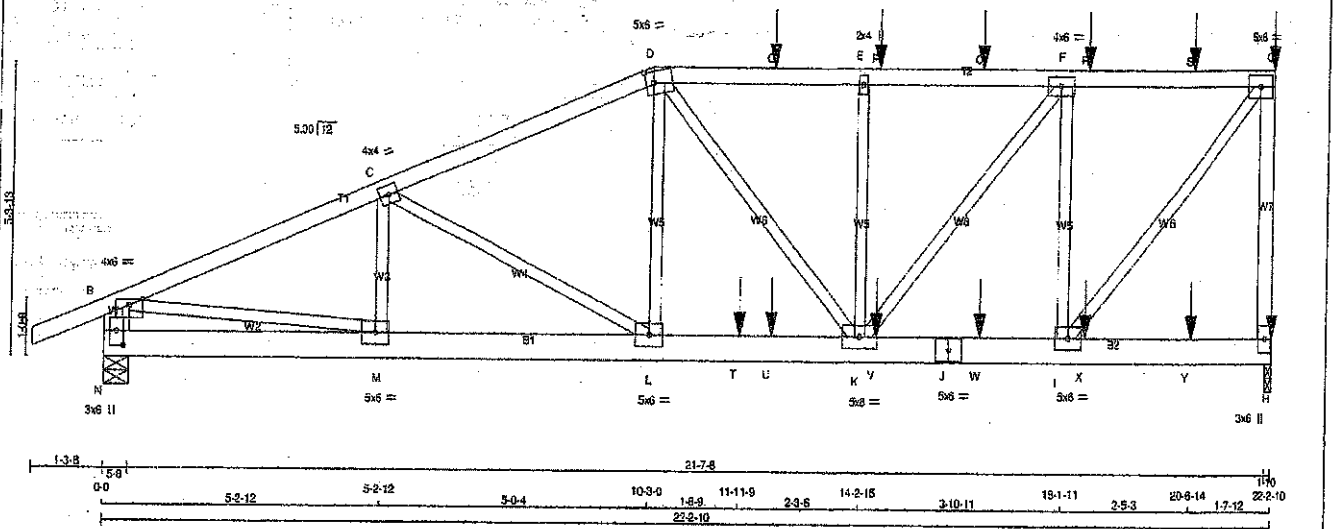

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
N - J	2x6	DRY	No.2
J - H	2x6	DRY	No.2
J - H	2x6	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.
DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS	BROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS			
A-D	1	12	TOP
D-G	1	12	SIDE(61.0)
G-H	1	12	TOP
H-J	2	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS			
N-J	2	12	SIDE(183.1)
J-H	2	12	SIDE(0.0)
WEBS: (0.122"x3") SPIRAL NAILS			
2x3	1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE				
B TMVW-p	MT20	4.0	6.0	Edge
C TMVW-l	MT20	4.0	4.0	
D TTWW-m	MT20	5.0	6.0	2.50 1.75
E TMVW-w	MT20	2.0	4.0	
F TMVW-l	MT20	4.0	6.0	
G TMVW-l	MT20	5.0	8.0	
H BMV1-p	MT20	3.0	8.0	
I L M				
I BMVW-l	MT20	5.0	6.0	
J BS-l	MT20	5.0	6.0	
K BMVW-w	MT20	5.0	8.0	
N BMV1-p	MT20	3.0	6.0	3.25 1.50

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	DOWN	HORIZ	UPLIFT
H	2745	0	2745	0
N	2223	0	2223	0

UNFACTORED REACTIONS	1ST LCASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	SNOW
H	1931	1327
N	1590	1094

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, N

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.59 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)	MAX. UNBRACED LENGTH	WEBS	MEMB.	FORCE (LBS)	MAX. FACTORED CS1 (LC)
FR-TO						FR-TO			
A-B	0/26					M-C	-466	0	0.05 (1)
B-C	-3551	0	-102.0	-102.0	0.07 (1)	C-D	-208	0	0.08 (1)
C-D	-3401	0	-102.0	-102.0	0.28 (1)	D-E	0/1040		0.13 (1)
D-E	-3024	0	-102.0	-102.0	0.20 (1)	E-F	0/2913		0.36 (1)
E-F	-3024	0	-102.0	-102.0	0.30 (1)	F-G	-184	0	0.08 (1)
F-G	-3024	0	-102.0	-102.0	0.23 (1)	G-H	-2208	0	0.45 (1)
G-H	-3024	0	-102.0	-102.0	0.23 (1)	H-I	-672	0	0.14 (1)
H-I	-1854	0	-102.0	-102.0	0.21 (1)	I-J	0/1890		0.23 (1)
I-J	-1854	0	-102.0	-102.0	0.21 (1)	J-K	0/3324		0.41 (1)
J-K	-1854	0	-102.0	-102.0	0.21 (1)				
K-L	-2843	0	0.0	0.0	0.81 (1)				
L-M	-2139	0	0.0	0.0	0.07 (1)				
M-N	0/0		-18.5	-18.5	0.07 (1)				
N-O	0/3208		-18.5	-18.5	0.35 (1)				
O-P	0/3139		-18.5	-18.5	0.52 (1)				
P-Q	0/3139		-18.5	-18.5	0.52 (1)				
Q-R	0/1854		-18.5	-18.5	0.21 (1)				
R-S	0/1854		-18.5	-18.5	0.21 (1)				
S-T	0/1854		-18.5	-18.5	0.21 (1)				
T-U	0/1854		-18.5	-18.5	0.21 (1)				
U-V	0/0		-18.5	-18.5	0.04 (4)				
V-W	0/0		-18.5	-18.5	0.04 (4)				
W-X	0/0		-18.5	-18.5	0.04 (4)				
X-Y	0/0		-18.5	-18.5	0.04 (4)				
Y-Z	0/0		-18.5	-18.5	0.04 (4)				

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	FACE	DIR.	TOTAL	CS1
G	22-2-10	-164	-164	---	FRONT	VERT	TOTAL	C1
H	22-2-10	-35	-35	---	FRONT	VERT	TOTAL	C1
O	12-8-14	-123	-123	---	FRONT	VERT	TOTAL	C1
P	14-8-14	-123	-123	---	FRONT	VERT	TOTAL	C1
Q	16-6-14	-123	-123	---	FRONT	VERT	TOTAL	C1
R	18-6-14	-123	-123	---	FRONT	VERT	TOTAL	C1
S	20-6-14	-123	-123	---	FRONT	VERT	TOTAL	C1
T	11-11-9	-1206	-1206	---	FRONT	VERT	TOTAL	C1
U	12-8-14	-27	-27	---	FRONT	VERT	TOTAL	C1
V	14-6-14	-27	-27	---	FRONT	VERT	TOTAL	C1
W	16-6-14	-27	-27	---	FRONT	VERT	TOTAL	C1
X	18-6-14	-27	-27	---	FRONT	VERT	TOTAL	C1
Y	20-6-14	-27	-27	---	FRONT	VERT	TOTAL	C1

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OSC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

65 % OF 37.5 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.74")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (0.74")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CS1: TC=0.61/1.00 (G-H:1), BC=0.52/1.00 (K-L:1), WB=0.45/1.00 (F-1:1), SS=0.26/1.00 (K-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 334 1987 789 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.88 (5) (INPUT = 0.90)
JSI METAL = 0.41 (M) (INPUT = 1.00)

Structural component only
DWG# T-1923489 CONTINUED ON PAGE 2

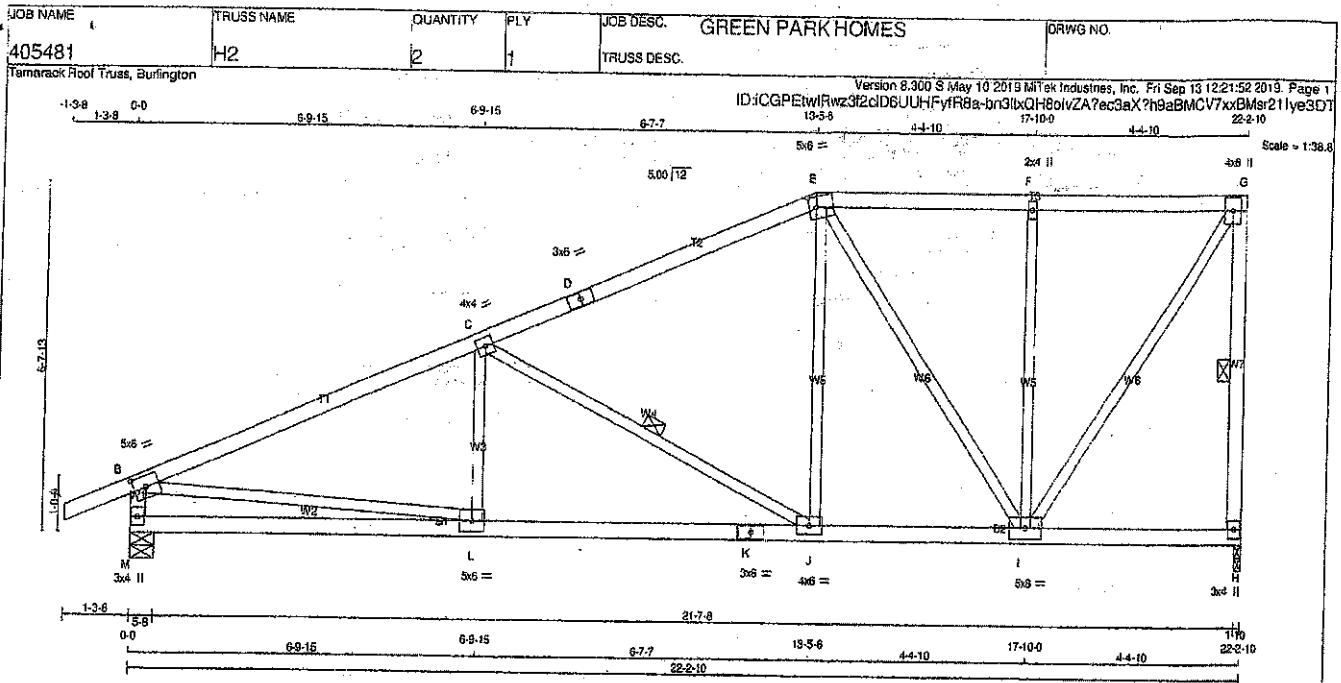

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF
M - B	2x4	DRY	No.2	SPF
M - K	2x4	DRY	No.2	SPF
K - H	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B - TMVW-t	MT20	5.0	6.0	2.50	2.75
C - TMVW-t	MT20	4.0	4.0		
D - TS-t	MT20	3.0	6.0		
E - TMVW-m	MT20	5.0	6.0	2.50	1.75
F - TMVW-w	MT20	2.0	4.0		
G - TMVW-p	MT20	4.0	6.0		
H - BMV1-p	MT20	3.0	4.0		
I - BMVWV-t	MT20	5.0	6.0		
J - BMVWV-t	MT20	4.0	6.0		
K - BS-t	MT20	3.0	6.0		
L - BMVW-t	MT20	5.0	6.0		
M - BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORIZ	MAXIMUM FACTORED GROSS REACTION	INPUT 9R8	REQD IN-SX
H	1339	0	1339	0	1-10
M	1476	0	1476	0	5-6

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	942	644 / 0	0 / 0	0 / 0	0 / 0	298 / 0	0 / 0
M	1037	723 / 0	0 / 0	0 / 0	0 / 0	314 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.85 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-H, C-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	LC1 MAX CS1 (L/C)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (L/C)		
FR-TO		FROM TO	(PLF)		FR-TO				
A-B	0 / 26	-102.0	-102.0	0.13 (1)	10.00	L-C	-72 / 98	0.03 (4)	
B-C	-2088 / 0	-102.0	-102.0	0.70 (1)	3.85	C-J	-929 / 0	0.37 (1)	
C-D	-1244 / 0	-102.0	-102.0	0.62 (1)	4.87	E-I	0 / 542	0.12 (1)	
D-E	-1244 / 0	-102.0	-102.0	0.62 (1)	4.87	E-I	-804 / 0	0.70 (1)	
E-F	-786 / 0	-102.0	-102.0	0.25 (1)	6.25	I-F	-552 / 0	0.40 (1)	
F-G	-786 / 0	-102.0	-102.0	0.25 (1)	6.25	I-G	0 / 1376	0.31 (1)	
G-H	-1303 / 0	0.0	0.0	0.28 (1)	5.68	B-L	0 / 1949	0.44 (1)	
M-B	-1423 / 0	0.0	0.0	0.14 (1)	6.84				
M-L	0 / 0	-18.5	-18.5	0.21 (4)	10.00				
L-K	0 / 1938	-18.5	-18.5	0.40 (1)	10.00				
K-J	0 / 1938	-18.5	-18.5	0.40 (1)	10.00				
J-I	0 / 1127	-18.5	-18.5	0.25 (1)	10.00				
I-H	0 / 0	-18.5	-18.5	0.07 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 20.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.74")
CALCULATED VERT. DEFL. (LL) = L/999 (0.08")
ALLOWABLE DEFL. (TL) = L/360 (0.74")
CALCULATED VERT. DEFL. (TL) = L/999 (0.15")

CS: TC=0.70/1.00 (B-C-1), BC=0.40/1.00 (J-L-1), WB=0.70/1.00 (E-I-1), SS=0.31/1.00 (B-C-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENG=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.86 (I) (INPUT = 0.80)
JSI METAL = 0.58 (K) (INPUT = 1.00)

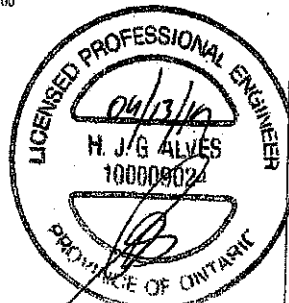

Structural component only
DWG# T-1923490

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
405481	H3	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.300 S May 10 2019 M Tek Industries, Inc. Fri Sep 13 12:21:53 2019 Page 1
ID:CGPElwiRwz3f2cdD6UHFyIR8a-3zd74Hrvv5tIBKag9n6mYulpm20sSKbWabaky3DS
16-7-13 22-2-10 Scale = 1:4.0

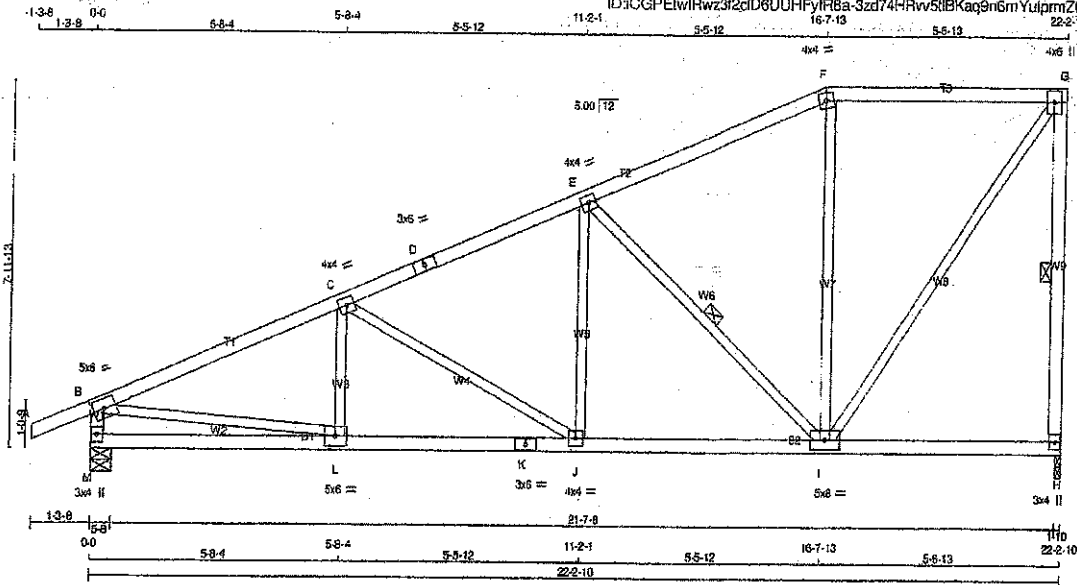

TOTAL WEIGHT = 2 X 98 = 196 lb

LUMBER	SIZE	DRY	NO.2
N. L. G. A. RULES			
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
J - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN Y	X
B TMVW-I	MT20	5.0	6.0	2.50 2.75
C TMVW-I	MT20	4.0	4.0	
D TS4	MT20	3.0	6.0	
E TMVW-I	MT20	4.0	4.0	
F TTW-m	MT20	4.0	4.0	
G TMVW-p	MT20	4.0	6.0	
H BMV1-p	MT20	3.0	4.0	
I BMVWW-I	MT20	5.0	8.0	
J BMVW-I	MT20	4.0	4.0	
K BS-I	MT20	3.0	6.0	
L BMVW-I	MT20	5.0	6.0	
M BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	0	1-10
H	1338	0	0	5-8
M	1476	0	0	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
JT COMBINED	SNOW	LIVE	PERM. LIVE	
H	942	844 / 0	0 / 0	298 / 0
M	1037	723 / 0	0 / 0	314 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 4.26 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-H, E-I

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PL)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0.126	-102.0 -102.0 0.13 (1)	L-C	-143 / 51
B-C	-2087 / 0	-102.0 -102.0 0.45 (1)	C-J	-569 / 0
C-D	-1561 / 0	-102.0 -102.0 0.36 (1)	J-E	0 / 376
D-E	-1591 / 0	-102.0 -102.0 0.36 (1)	E-I	-997 / 0
E-F	-805 / 0	-102.0 -102.0 0.35 (1)	I-F	-207 / 13
F-G	-721 / 0	-102.0 -102.0 0.41 (1)	G-I	0 / 1246
G-H	-1298 / 0	0.0 0.0 0.37 (1)	B-L	0 / 1843
H-M	-1430 / 0	0.0 0.0 0.14 (1)		
N-L	0 / 0	-18.5 -18.5 0.13 (4)		
L-K	0 / 1927	-18.5 -18.5 0.36 (1)		
K-J	0 / 1927	-18.5 -18.5 0.36 (1)		
J-I	0 / 1441	-18.5 -18.5 0.30 (1)		
I-H	0 / 0	-18.5 -18.5 0.14 (2)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.0 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65% OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.74")
CALCULATED VERT. DEFL. (LL) = 1/999 (0.07")
ALLOWABLE DEFL. (TL) = L/360 (0.74")
CALCULATED VERT. DEFL. (TL) = 1/999 (0.14")

CSI: TC=0.45/1.00 (B-C:1), BC=0.36/1.00 (J-L:1), WB=0.44/1.00 (B-L:1), SS=0.25/1.00 (B-C:1)

DOI LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.



NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1567 788 1567 1556

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.84 (L) (INPUT = 0.90)
JSI METAL=0.57 (K) (INPUT = 1.00)

Structural component only
DWG# T-1923491

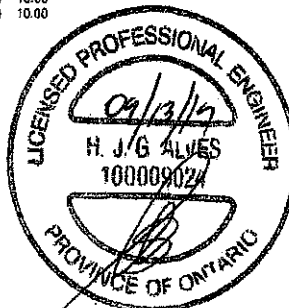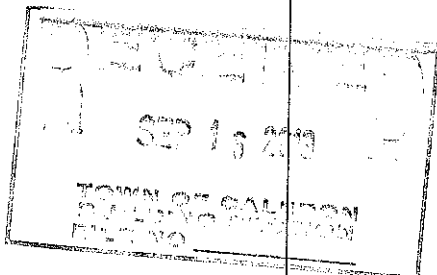

JOB NAME 405481	TRUSS NAME H4	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.300 S May 10 2019 MTek Industries, Inc. Fri Sep 13 12:21:54 2019 Page 1	
ID:CGPEWIRw23f2cD6UHFYR8a-XABWIDRkP?coT90Jld756ExYAt1boUpAK86Aya3DR				Scale = 1:51.2	

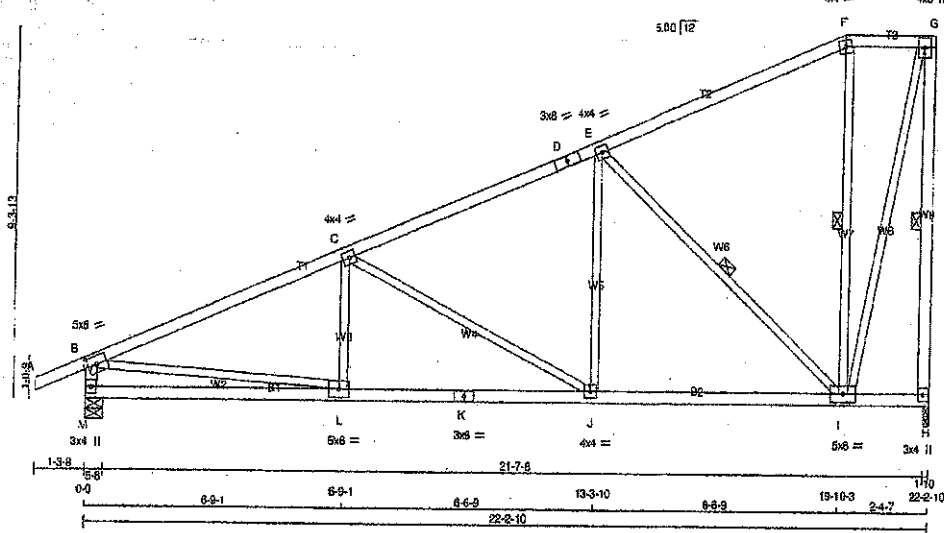

TOTAL WEIGHT = 2 X 105 = 210 LB

LUMBER	N L G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - G	2x4	DRY	No.2	SPF	
H - G	2x4	DRY	No.2	SPF	
M - B	2x4	DRY	No.2	SPF	
M - K	2x4	DRY	No.2	SPF	
K - H	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-I	MT20	5.0	6.0	2.50	2.75
C	TMVW-I	MT20	4.0	4.0		
D	TS-I	MT20	3.0	8.0		
E	TMVW-I	MT20	4.0	4.0		
F	TTW-m	MT20	4.0	4.0		
G	TMVW-p	MT20	4.0	6.0		
H	BMV1-p	MT20	3.0	4.0		
I	BMVW-W-I	MT20	5.0	8.0		
J	BMVW-I	MT20	4.0	4.0		
K	BS-I	MT20	3.0	6.0		
L	BMVW-I	MT20	5.0	8.0		
M	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
H	1399	0	1399	0	0	1-10	1-10	5-8	5-8
M	1476	0	1476	0	0	5-8	5-8		
UNFACTORED REACTIONS									
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
H	942	644 / 0	0 / 0	0 / 0	0 / 0	298 / 0	0 / 0		
M	1037	723 / 0	0 / 0	0 / 0	0 / 0	314 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-H, E-I, F-I.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 26	-102.0 -102.0	0.13 (1)	10.00	L-C	-79 / 88	0.03 (4)
B-C	-2042 / 0	-102.0 -102.0	0.65 (1)	3.99	C-J	-787 / 0	0.87 (1)
C-D	-1318 / 0	-102.0 -102.0	0.50 (1)	5.00	J-E	0 / 505	0.11 (1)
D-E	-1318 / 0	-102.0 -102.0	0.50 (1)	5.00	E-I	-1252 / 0	0.73 (1)
E-F	-358 / 0	-102.0 -102.0	0.51 (1)	6.25	I-F	-261 / 0	0.15 (1)
F-G	-304 / 0	-102.0 -102.0	0.07 (1)	6.25	F-G	0 / 1249	0.28 (1)
G-H	-1381 / 0	0.0 0.0	0.54 (1)	5.62	B-L	0 / 1920	0.43 (1)
M-B	-1423 / 0	0.0 0.0	0.14 (1)	6.84			
M-L	0 / 0	-18.5 -18.5	0.18 (4)	10.00			
L-K	0 / 1909	-18.5 -18.5	0.40 (1)	10.00			
K-J	0 / 1909	-18.5 -18.5	0.40 (1)	10.00			
J-I	0 / 1217	-18.5 -18.5	0.29 (1)	10.00			
I-H	0 / 0	-18.5 -18.5	0.11 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.0 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, OBC 2012
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(56 % OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.74")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.74")
CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.65/1.00 (B-C:1), BC=0.40/1.00 (J-L:1), WB=0.87/1.00 (C-J:1), SS=0.29/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(FSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.86 (G) (INPUT = 0.90)
JSI METAL = 0.93 (K) (INPUT = 1.00)

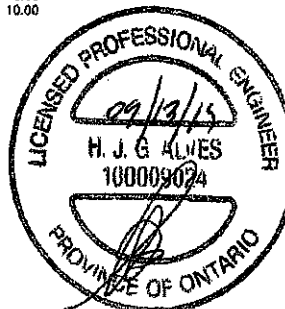

Structural component only
DWG# T-1923492

JOB NAME 405481	TRUSS NAME H5	QUANTITY 22	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

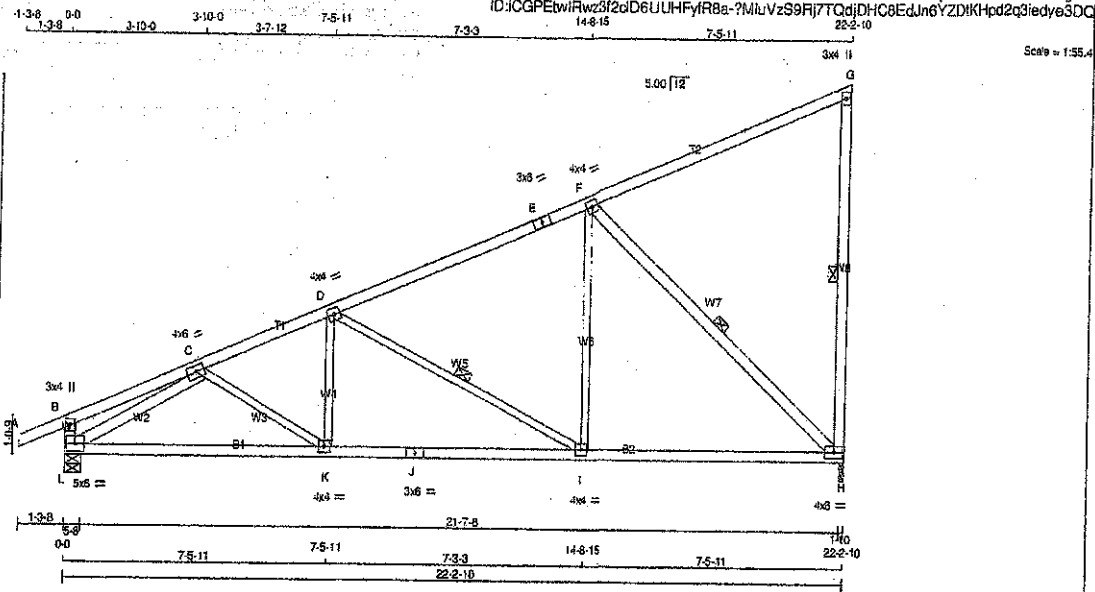

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	
A - E	2x4 DRY	No.2	
E - G	2x4 DRY	No.2	
H - J	2x4 DRY	No.2	
L - B	2x4 DRY	No.2	
J - H	2x4 DRY	No.2	
ALL WEBS	2x3 DRY	No.2	
EXCEPT			
F - H	2x4 DRY	No.2	
L - C	2x4 DRY	No.2	

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-1	MT20	4.0	6.0		
D	TMWW-1	MT20	4.0	4.0		
E	TS-1	MT20	3.0	6.0		
F	TMWW-1	MT20	4.0	4.0		
G	TMV+p	MT20	3.0	4.0		
H	BMWW-1	MT20	4.0	6.0		
I	BMWW-1	MT20	4.0	4.0		
J	BS-1	MT20	3.0	6.0		
K	BMWW-1	MT20	4.0	4.0		
L	BMWW-1	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
	FACTORED	MAXIMUM FACTORED	INPUT
	GROSS REACTION	GROSS REACTION	BRG
	DOWN	UP	IN-SX
JT	1339 0	1339 0	1-10
H	1478 0	1476 0	5-6
L			

UNFACTORED REACTIONS			
1ST LCASE	MAX/MIN	COMPONENT REACTIONS	
	COMBINED	SNOW	LIVE
		PERM.LIVE	WIND
			DEAD
			SOIL
JT	942	644 / 0	0 / 0
H	1037	723 / 0	0 / 0
L			

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, L


BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.50 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-H, D-I, F-H.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. CS (LC)
FR-TO		FROM TO	LENGTH FR-TO
A-B	0 / 26	-102.0 -102.0	0.13 (1)
B-C	0 / 8	-102.0 -102.0	0.20 (1)
C-D	-1944 / 0	-102.0 -102.0	0.33 (1)
D-E	-1140 / 0	-102.0 -102.0	0.69 (1)
E-F	-1140 / 0	-102.0 -102.0	0.69 (1)
F-G	-32 / 0	-102.0 -102.0	0.70 (1)
G-H	-298 / 0	0.0 0.0	0.16 (1)
H-I	-308 / 0	0.0 0.0	0.03 (1)
L-K	0 / 1805	-18.5 -18.5	0.42 (1)
K-J	0 / 1812	-18.5 -18.5	0.43 (1)
J-I	0 / 1812	-18.5 -18.5	0.43 (1)
I-H	0 / 1089	-18.5 -18.5	0.32 (1)

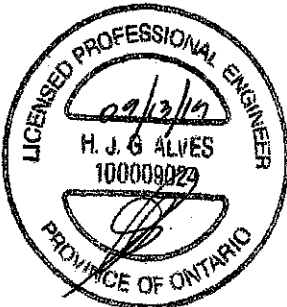

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	DL =	28.0	PSF
	LL =	6.0	PSF
BOT CH.	DL =	0.0	PSF
	LL =	7.4	PSF
TOTAL LOAD		42.4	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NSCC 2015.

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, NSCC 2015
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65 % OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.74")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (0.74")
CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.70/1.00 (F-G:1), BC=0.43/1.00 (I-K:1), WB=0.76/1.00 (F-H:1), SS=0.33/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP (DRY)	SHEAR	SECTION
	(PSI)	(PL)	(PL)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (F) (INPUT = 0.60)


JSI METAL = 0.57 (J) (INPUT = 1.00)

Structural component only
DWG# T-1923493

JOB NAME 405481	TRUSS NAME H7	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.300 S May 10 2019 Mitek Industries, Inc. Fri Sep 13 12:21:56 2019 Page 1
ID:CGP2w1Rwz3I2cd6UJHFYR8a-TYJGJITnCOFK2nIPvtAXKP2zcl3sQnHUpFA3ye3DP
Scale = 1:30.3

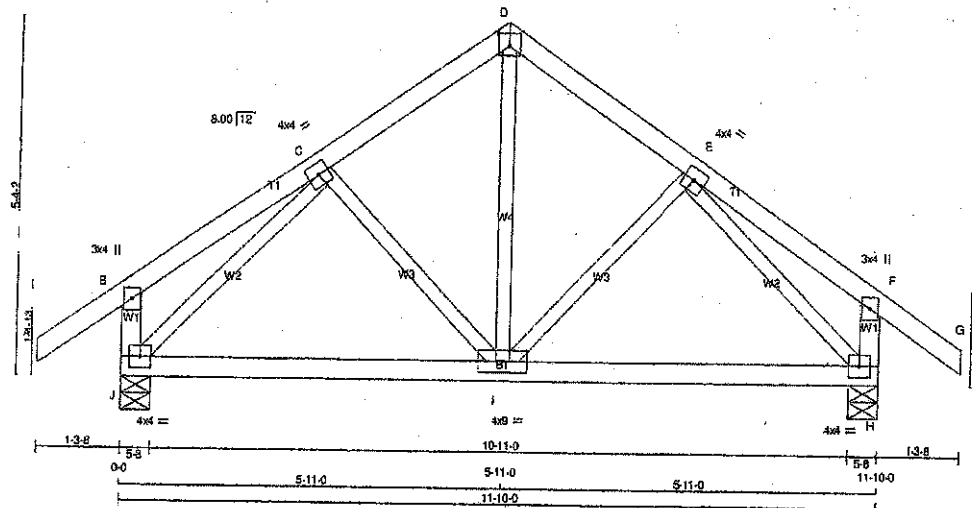

TOTAL WEIGHT = 6 X 52 = 314 LB

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	IN-SX	IN-SX
J 853	0	0	5-8
H 853	0	0	5-8

UNFACTORED REACTIONS			
1ST LCASE	MAX/MIN	COMPONENT REACTIONS	
JT COMBINED	SNOW	LIVE	PERM. LIVE
J 598	423 / 0	0 / 0	0 / 0
H 598	423 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CS (LBS)
FR-TO			
A-B	0 / 39	-102.0	-102.0
B-C	0 / 18	-102.0	-102.0
C-D	-540 / 0	-102.0	-102.0
D-E	-540 / 0	-102.0	-102.0
E-F	0 / 18	-102.0	-102.0
F-G	0 / 39	-102.0	-102.0
J-B	-257 / 0	0.0	0.0
H-F	-257 / 0	0.0	0.0
J-I	0 / 538	-18.5	-18.5
I-H	0 / 538	-18.5	-18.5

WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LBS)	
I-D	0 / 342	0.08 (1)	
I-E	-145 / 0	0.04 (1)	
C-I	-145 / 0	0.04 (1)	
J-C	-770 / 0	0.22 (1)	
E-H	-770 / 0	0.22 (1)	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. G.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.39")

CALCULATED VERT. DEFL. (LL) = L/999 (0.01")

ALLOWABLE DEFL. (TL) = L/360 (0.39")

CALCULATED VERT. DEFL. (TL) = L/999 (0.04")

CSI: TC=0.14/1.00 (A-B-1), BC=0.22/1.00 (J-I-4), WB=0.22/1.00 (C-I-1), SI=0.12/1.00 (C-D-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN



MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.70 (C) (INPUT = 0.90)

JSI METAL = 0.27 (E) (INPUT = 1.00)

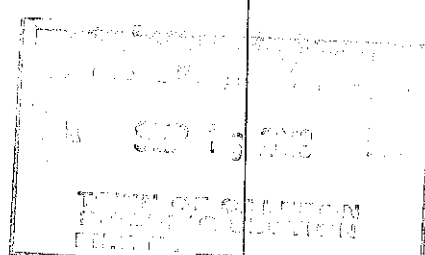


Structural component only
DWG# T-1923494

JOB NAME 405481	TRUSS NAME H7G	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Jamrack Roof Truss, Burlington

Version 2.300 S May 10 2019 Mitek Industries, Inc. Fri Sep 13 12:21:57 2019 Page 1

ID:CGPEwIRwz3R2cD8UHFyR8a-xtewfUQykNBgxbCdAikSaoN?icLXwW8YpVyo3DC

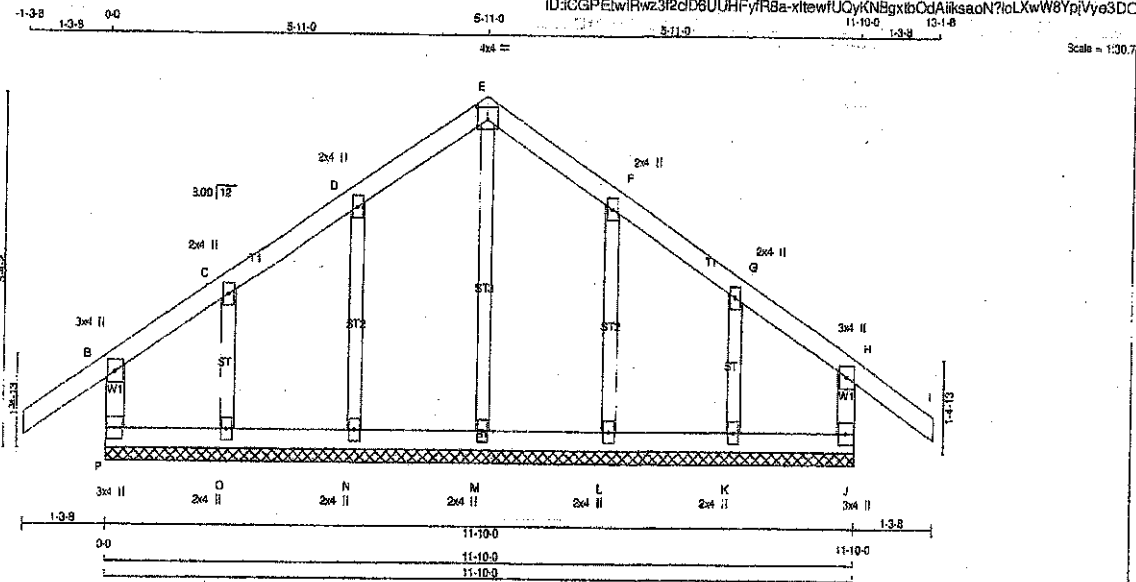

TOTAL WEIGHT = 2 X 49 = 97 lb

LUMBER					
N. L. G. A. RULES					
CHORDS	SIZE		LUMBER	DESCR	
P - B	2x4	DRY	No.2	SPF	
A - E	2x4	DRY	No.2	SPF	
E - I	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
P - J	2x4	DRY	No.2	SPF	
ALL WEBS		2x3	DRY	No.2	SPF
ALL GABLE WEBS		2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.					

GABLE STUDS SPACED AT 2'-0" OC.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING			
TOTAL LOAD CASES: (4)			
CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
P-B	-241 / 0	M-E	-250 / 0
A-B	0 / 39	N-D	-217 / 0
B-C	0 / 15	O-C	-161 / 0
C-D	0 / 39	L-F	-217 / 0
D-E	0 / 36	K-G	-161 / 0
E-F	0 / 39		
F-G	0 / 39		
G-H	0 / 15		
H-I	0 / 39		
J-H	-241 / 0		
P-O	-23 / 0		
O-N	-29 / 0		
N-M	-33 / 0		
M-L	-33 / 0		
L-K	-29 / 0		
K-J	-23 / 0		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 29.0 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC2010, NBC2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC2010, OBC 2012
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

CSL: TC=0.14/1.00 (A-B-1), BC=0.02/1.00 (K-L-1), WB=0.10/1.00 (E-M-1), SS=0.09/1.00 (A-B-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)

MAX MIN MAX MIN MAX MIN



MT20 618 354 1587 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (E) (INPUT = 0.90)

JSI METAL = 0.11 (D) (INPUT = 1.00)

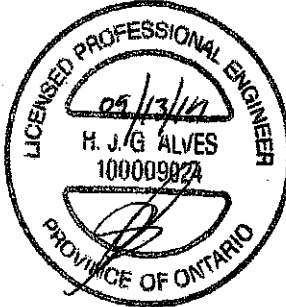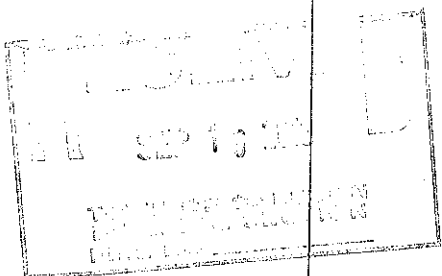

Structural component only
DWG# T-1923495

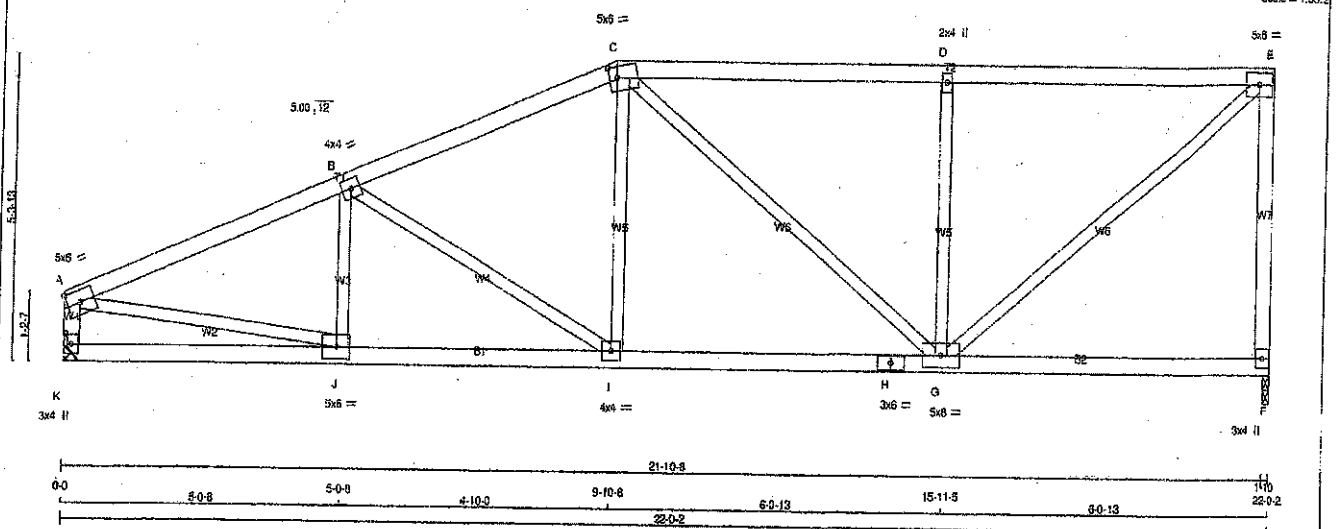

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - H	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (Table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-I	MT20	5.0	6.0		Edge
B	TMVW-I	MT20	4.0	4.0		
C	TTWW-m	MT20	5.0	6.0	2.25	1.75
D	TMVW-w	MT20	2.0	4.0		
E	TMVW-I	MT20	5.0	6.0		
F	BMV1-p	MT20	3.0	4.0		
G	BMVWW-I	MT20	5.0	6.0		
H	BS-I	MT20	3.0	6.0		
I	BMVWW-I	MT20	4.0	4.0		
J	BMVW-I	MT20	5.0	6.0		
K	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORIZ	UPLIFT
F	1326	0	1326	0
K	1326	0	1326	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT K. MINIMUM BEARING LENGTH AT JOINT K = 3'-8".

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	933	659 / 0	0 / 0	0 / 0	0 / 0	295 / 0	0 / 0
K	933	659 / 0	0 / 0	0 / 0	0 / 0	295 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.27 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID GELING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	-1950 / 0	-102.0 -102.0	0.49 (1)	4.27	J-B	-232 / 12	0.05 (1)
B-C	-1594 / 0	-102.0 -102.0	0.46 (1)	4.88	B-I	-446 / 0	0.25 (1)
C-D	-1267 / 0	-102.0 -102.0	0.70 (1)	4.50	I-C	0 / 332	0.07 (1)
D-E	-1267 / 0	-102.0 -102.0	0.71 (1)	4.60	C-G	-235 / 0	0.29 (1)
E-F	-1280 / 0	0.0 0.0	0.63 (1)	7.13	G-D	-767 / 0	0.32 (1)
K-A	-1284 / 0	0.0 0.0	0.13 (1)	7.11	G-E	0 / 1541	0.37 (1)
K-J	0 / 0	-18.5 -18.5	0.09 (4)	10.00	A-J	0 / 1849	0.42 (1)
J-I	0 / 1820	-18.5 -18.5	0.35 (1)	10.00			
I-H	0 / 1448	-18.5 -18.5	0.31 (1)	10.00			
H-G	0 / 1448	-18.5 -18.5	0.31 (1)	10.00			
G-F	0 / 0	-18.5 -18.5	0.17 (4)	10.00			

TOTAL WEIGHT = 2 X 88 = 176 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 29.0 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 42.4 PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

(55% OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/960 (0.73")

CALCULATED VERT. DEFL.(LL) = L/999 (0.06")

ALLOWABLE DEFL.(TL) = L/960 (0.73")

CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.71/1.00 (D-E:1), BC=0.35/1.00 (I-J:1)

WS=0.42/1.00 (A-J:1), SS=0.30/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 L.S.BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1807 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (G) (INPUT = 0.80)

JSI METAL = 0.50 (A) (INPUT = 1.00)



Structural component only
DWG# T-1923496

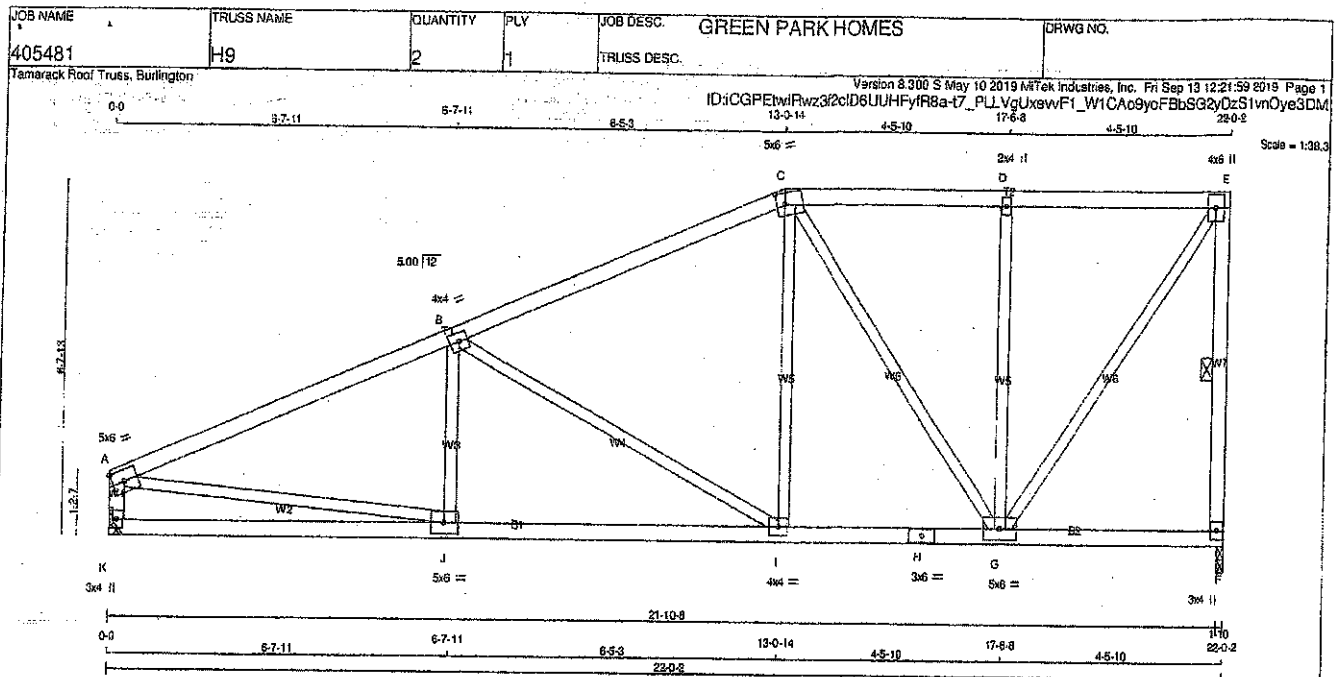

LUMBER				N.L.G.A. RULES	
CHORDS	SIZE	LUMBER	DESCR.	SPF	BUILDING DESIGNER
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
K - A	2x4	DRY	No.2	SPF	
K - H	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X	Edge
A	TMVV-1	MT20	5.0	6.0			
B	TMWW-1	MT20	4.0	4.0			
C	TTWW-m	MT20	5.0	6.0	2.50	1.75	
D	TMVV-w	MT20	2.0	4.0			
E	TMVV-w	MT20	4.0	6.0			
F	BMV1-p	MT20	3.0	4.0			
G	BMWWV-1	MT20	5.0	6.0			
H	BS-1	MT20	3.0	6.0			
I	BMWW-1	MT20	4.0	4.0			
J	BMWW-1	MT20	5.0	6.0			
K	BMV1-p	MT20	3.0	4.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG	
F	1326 0	1326 0	0	1-10	1-10
K	1326 0	1326 0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT K. MINIMUM BEARING LENGTH AT JOINT K = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	833	638 / 0	0 / 0	0 / 0	0 / 0	295 / 0	0 / 0
K	933	638 / 0	0 / 0	0 / 0	0 / 0	295 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-F.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	-1981 / 0	J-B	-114 / 80
B-C	-1232 / 0	B-I	-837 / 0
C-D	-789 / 0	I-C	0 / 512
D-E	-790 / 0	C-G	-671 / 0
E-F	-1290 / 0	G-D	-563 / 0
K-A	-1275 / 0	G-E	0 / 1385
		A-J	0 / 1855
K-J	0 / 0		
I-I	0 / 1829		
I-H	0 / 1116		
H-G	0 / 1116		
G-F	0 / 0		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 29.0 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 42.4 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 089-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.73")
CALCULATED VERT. DEFL. (LL) = L/999 (0.07")
ALLOWABLE DEFL. (TL) = L/360 (0.73")
CALCULATED VERT. DEFL. (TL) = L/999 (0.14")

CSI: TC=0.65/1.00 (A-B:1), BC=0.38/1.00 (J-I:1), WB=0.94/1.00 (B-I:1), SSI=0.30/1.00 (A-B:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP (DRY)	SHEAR (PS)	SECTION (PL)
MT20	818	354	1667
	818	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.83 (G) (INPUT = 0.80)
JSI METAL = 0.51 (A) (INPUT = 1.00)

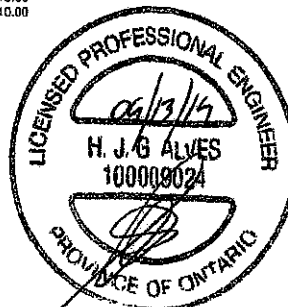

Structural component only
DWG# T-1923497

JOB NAME 405481	TRUSS NAME H10	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.300 S May 10 2019 MITek Industries, Inc. Fri Sep 13 13:22:00 2019 Page 1
 ID:ICGPElWfRwz3f2cDsUHFyIR8a-MKYNhWIFFmmXOca4IKPKNU1MaxO?dQMC6nTJqye3DL

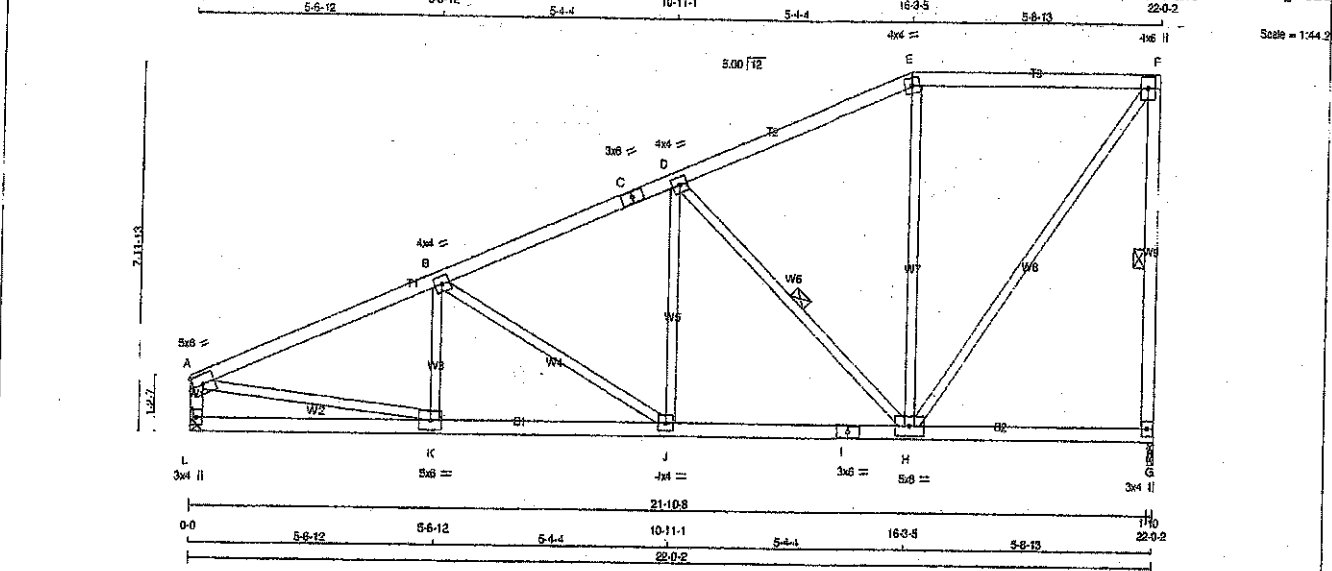

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF
C - E	2x4 DRY	No.2	SPF
E - F	2x4 DRY	No.2	SPF
G - F	2x4 DRY	No.2	SPF
L - A	2x4 DRY	No.2	SPF
L - I	2x4 DRY	No.2	SPF
I - G	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			

DRY, SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A - TMVW-1	MT20	5.0	6.0		Edge
B - TMVW-1	MT20	4.0	4.0		
C - TS-1	MT20	3.0	6.0		
D - TMVW-1	MT20	4.0	4.0		
E - TW-1	MT20	4.0	6.0		
F - TMVW-1	MT20	4.0	4.0		
G - BMV1-p	MT20	3.0	4.0		
H - BMVW-1	MT20	5.0	8.0		
I - BS-1	MT20	3.0	6.0		
J - BMVW-1	MT20	4.0	4.0		
K - BMVW-1	MT20	5.0	6.0		
L - BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING DESIGNER									
BEARINGS									
FACTORED			MAXIMUM FACTORED			INPUT		REQD	
GROSS REACTION			GROSS REACTION			BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX		IN-SX	
G	1326	0	1326	0	0	1-10		1-10	
L	1326	0	1326	0	0	MECHANICAL			

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT L. MINIMUM BE

LENGTH AT JOINT L = 3'-8".

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT L. MINIMUM BEARING LENGTH AT JOINT L = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS	DEAD	SOIL
G	933	638 / 0	0 / 0	0 / 0	295 / 0
L	933	638 / 0	0 / 0	0 / 0	295 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.0 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-G, D-H.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	MAX. (LBS)	MEMB.	FORCE (LBS)	MAX. (LBS)	CS (LBS)
FR-TO		FROM	TO	FR-TO			
A-B	-1945 / 0	-102.0	-102.0	4.40	K-B	-185 / 36	0.04 (1)
B-C	-1515 / 0	-102.0	-102.0	4.97	B-J	-485 / 0	0.34 (1)
C-D	-1515 / 0	-102.0	-102.0	4.97	J-D	0 / 345	0.08 (1)
D-E	-811 / 0	-102.0	-102.0	6.25	D-H	-945 / 0	0.38 (1)
E-F	-726 / 0	-102.0	-102.0	6.25	H-E	-208 / 13	0.25 (1)
G-F	-1284 / 0	0.0	0.0	5.69	H-F	0 / 1230	0.28 (1)
L-A	-1281 / 0	0.0	0.0	7.13	A-K	0 / 1837	0.41 (1)
L-K	0 / 0	-18.5	-18.5	0.12 (4)			
K-J	0 / 1814	-18.5	-18.5	0.34 (1)			
J-I	0 / 1388	-18.5	-18.5	0.30 (1)			
I-H	0 / 1388	-18.5	-18.5	0.30 (1)			
H-G	0 / 0	-18.5	-18.5	0.14 (4)			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 29.0 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ORC 2012

- CSA 088-08, CSA 088-14

- TRC 2011, TRC 2014

(55 % OF 37.5 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (0.73")

CALCULATED VERT. DEFL.(LL) = 1/999 (0.07")

ALLOWABLE DEFL.(TL) = 1/360 (0.73")

CALCULATED VERT. DEFL.(TL) = 1/999 (0.13")

CSL: TC=0.44/1.00 (E-F:1), SC=0.34/1.00 (J-K:1),

WB=0.41/1.00 (A-K:1), SS=0.26/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 618 354 1667 738 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.82 (K) (INPUT = 0.90)

JSI METAL= 0.50 (A) (INPUT = 1.00)



Structural component only
 DWG# T-1923498

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
405481	H11	2	1	GREEN PARK HOMES		
Tamarack Roof Truss, Burlington						

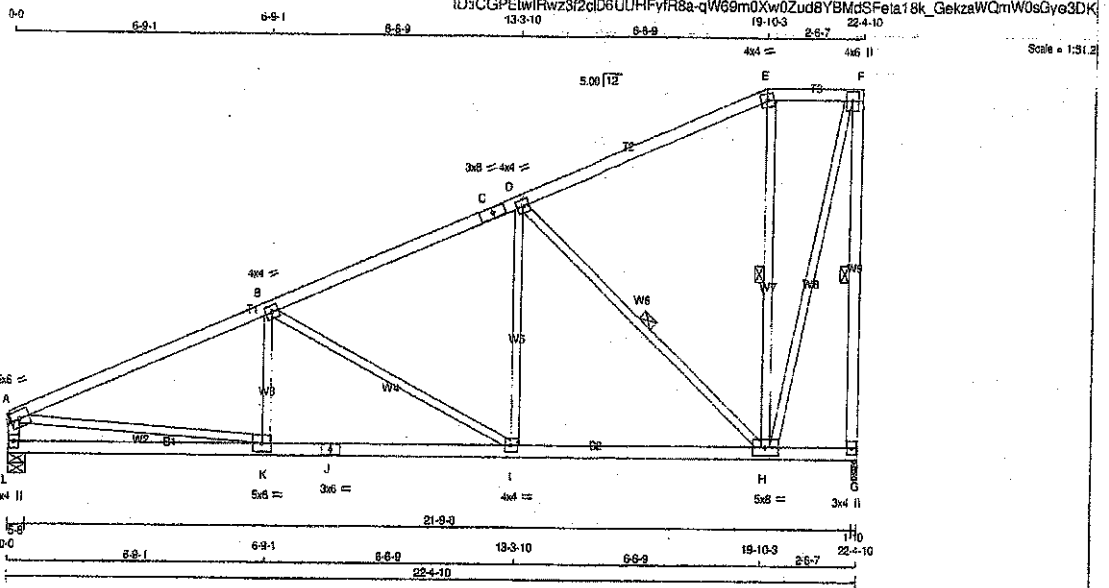

TOTAL WEIGHT = 2 X 104 = 208 lb

LUMBER					
N. L. & A. RULES					
CHORDS		SIZE	LUMBER		DESCR
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
L - A	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
J - G	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATE TYPE	PLATES	W	LEN	Y	X
A - TMVW-t	MT20	5.0	6.0		Edge
B - TMVW-t	MT20	4.0	4.0		
C - TS-t	MT20	3.0	8.0		
D - TMVW-t	MT20	4.0	4.0		
E - TTW-m	MT20	4.0	4.0		
F - TMVW-p	MT20	4.0	6.0		
G - BMV1-p	MT20	3.0	4.0		
H - BMVWW-t	MT20	5.0	8.0		
I - BMVW-t	MT20	4.0	4.0		
J - BS-t	MT20	3.0	8.0		
K - BMVW-t	MT20	5.0	6.0		
L - BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	DOWN	GROSS REACTION	BRG	BRG
JT VERT	HORZ	DOWN	HORZ	UPLIFT
G	1349	0	1349	0
L	1349	0	1349	0

UNFACTORED REACTIONS							
	1ST CASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
G	948	649 / 0	0 / 0	0 / 0	0 / 0	300 / 0	0 / 0
L	948	649 / 0	0 / 0	0 / 0	0 / 0	300 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.98 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-G, D-H, E-H.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 CSI (L/C)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 CSI (L/C)
FR-TO		FROM TO			FR-TO		
A-B	-2063 / 0	-102.0 -102.0	0.65 (1)	3.98	K-B	-91 / 87	0.03 (4)
B-C	-1341 / 0	-102.0 -102.0	0.50 (1)	4.97	B-I	-784 / 0	0.87 (1)
C-D	-1341 / 0	-102.0 -102.0	0.50 (1)	4.97	I-D	0 / 503	0.11 (1)
D-E	-382 / 0	-102.0 -102.0	0.51 (1)	6.25	D-H	-1250 / 0	0.73 (1)
E-F	-326 / 0	-102.0 -102.0	0.08 (1)	6.25	H-E	-261 / 0	0.15 (1)
G-F	-1340 / 0	0.0 0.0	0.55 (1)	5.80	H-F	0 / 1254	0.28 (1)
L-A	-1295 / 0	0.0 0.0	0.13 (1)	7.10	A-K	0 / 1839	0.44 (1)
L-K	0 / 0	-18.5 -18.5	0.18 (4)	10.00			
K-J	0 / 1927	-18.5 -18.5	0.40 (1)	10.00			
J-I	0 / 1927	-18.5 -18.5	0.40 (1)	10.00			
I-H	0 / 1239	-18.5 -18.5	0.29 (1)	10.00			
H-G	0 / 0	-18.5 -18.5	0.71 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

LOADING IN PLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.75")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.75")
CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CS1: TC=0.65/1.00 (A-B:1), BC=0.40/1.00 (I-K:1), WB=0.87/1.00 (B-I:1), SS=0.29/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1567 798 1987 1655

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (F) (INPUT = 0.90)
JSI METAL = 0.56 (J) (INPUT = 1.00)

Structural component only
DWG# T-1923499



JOB NAME 405481	TRUSS NAME H12	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

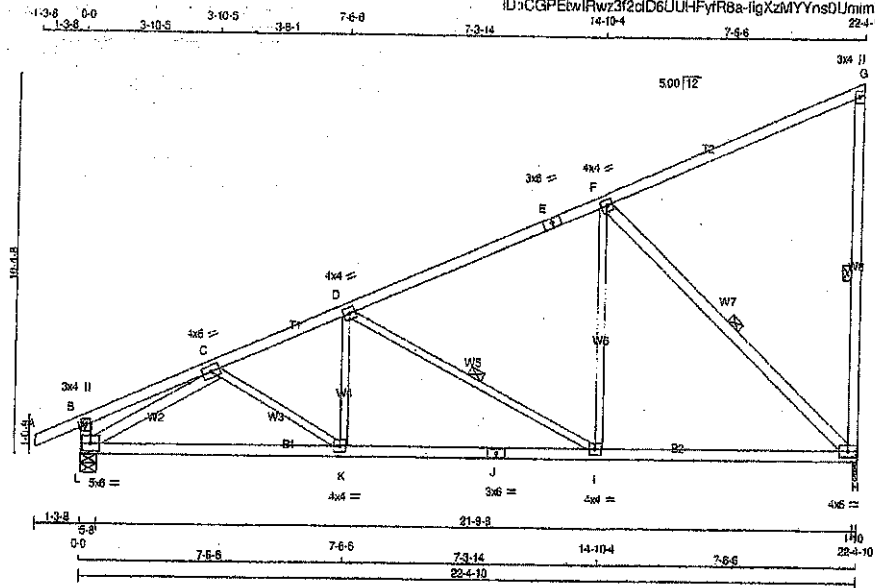

TOTAL WEIGHT = 5 X 101 = 605 lb

LUMBER	N. L. G. A. RULES	SIZE	LUMBER	DESCR.
A - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
H - I	2x4	DRY	No.2	SPF
L - B	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF

ALL WEBS	2x3	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
L - C	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	UP/LIFT	IN-SX	IN-SX	REQ'D
H	1349	0	1349	0	0	1-10	1-10	1-10	1-10
L	1486	0	1486	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS							
1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	948	849 / 0	0 / 0	0 / 0	0 / 0	300 / 0	0 / 0
L	1044	728 / 0	0 / 0	0 / 0	0 / 0	315 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.48 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-H, D-H, F-H.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING		TOTAL LOAD CASES: (4)	
CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO	FR-TO
A-B	0 / 26	-102.0 -102.0	0.13 (1)
B-C	0 / 8	-102.0 -102.0	0.20 (1)
C-D	-1962 / 0	-102.0 -102.0	0.34 (1)
D-E	-1149 / 0	-102.0 -102.0	0.71 (1)
E-F	-1149 / 0	-102.0 -102.0	0.71 (1)
F-G	-32 / 0	-102.0 -102.0	0.71 (1)
G-H	-300 / 0	0.0 0.0	0.16 (1)
H-I	-309 / 0	0.0 0.0	0.03 (1)
I-K	0 / 1826	-18.5 -18.5	0.42 (1)
K-J	0 / 1829	-18.5 -18.5	0.43 (1)
J-I	0 / 1829	-18.5 -18.5	0.43 (1)
I-H	0 / 1073	-18.5 -18.5	0.32 (4)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.75')
CALCULATED VERT. DEFL. (LL) = 1/989 (0.07')
ALLOWABLE DEFL. (TL) = L/360 (0.75')
CALCULATED VERT. DEFL. (TL) = 1/989 (0.15')

CSI: TC=0.71/1.00 (F-G:1), BC=0.43/1.00 (J-K:1), WB=0.78/1.00 (F-H:1), SSI=0.34/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PS)		(PL)		(PL)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1867	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (F) (INPUT = 0.90)
JSI METAL = 0.58 (J) (INPUT = 1.00)

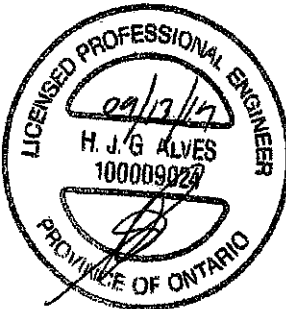

Structural component only
DWG# T-1923500


JOB NAME 405481	TRUSS NAME H14	QUANTITY 2	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 3.300 S May 10 2019 MTEK Industries, Inc. Fri Sep 13 12:22:03 2018 Page 1

ID:CGPwRwz32cID6UUHfYfR8a-mvEvBfYAYABLOsLlH6y?6X8ouDcrSpu477w9ye3D

Scale = 1:57.7

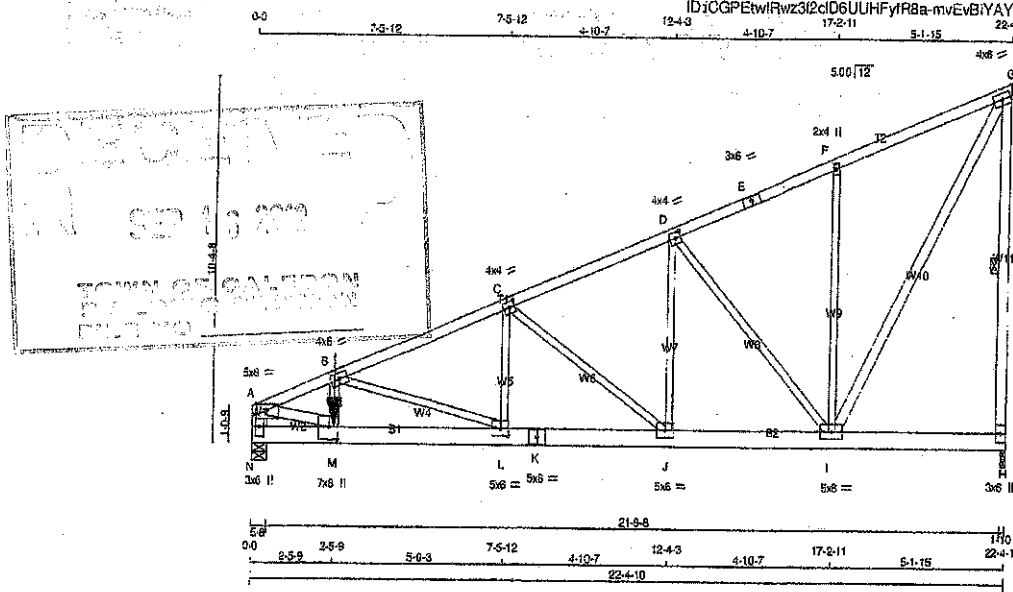

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - E	2x4	DRY	No.2	SPF		
E - G	2x4	DRY	No.2	SPF		
H - A	2x4	DRY	No.2	SPF		
N - A	2x6	DRY	No.2	SPF		
N - K	2x6	DRY	No.2	SPF		
K - H	2x6	DRY	No.2	SPF		
ALL WEBS EXCEPT						
M - B	2x4	DRY	No.2	SPF		
I - G	2x4	DRY	No.2	SPF		
A - M	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A - E 1 12	TOP	
E - G 1 12	TOP	
G - H 1 12	TOP	
N - A 2 12	TOP	
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
N - K 2 4	SIDE(671.4)	
K - H 2 12	TOP	
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1 6	SIDE(466.0)	
B - M 2 2		
2x4 1 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMW-p	MT20	5.0	8.0	Edge
B	TMWV-t	MT20	4.0	6.0	
C	TMWV-t	MT20	4.0	4.0	2.00 1.75
D	TMWV-t	MT20	4.0	4.0	2.00 1.75
E	TS-t	MT20	3.0	6.0	
F	TMWV-t	MT20	2.0	4.0	
G	TMWV-t	MT20	4.0	6.0	
H	BMV1-p	MT20	3.0	6.0	
I	BMWVW-t	MT20	5.0	6.0	
J	BMWV-t	MT20	5.0	6.0	
K	BS-t	MT20	5.0	6.0	
L	BMWV-t	MT20	5.0	6.0	2.50 2.75
M	BMWV-t	MT20	7.0	8.0	4.25 3.00
N	BMV1-p	MT20	3.0	6.0	3.25 1.50

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UP	IN-SX
H	1829 0	1829 0	0 0	1-10 1-10
N	5229 0	5229 0	0 0	5-8 5-8

UNFACTORED REACTIONS	1ST LOASE	MAX/MIN COMPONENT REACTIONS	PERM	LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	0/0	0/0	0/0	402/0	0/0
H	1266	884/0	0/0	0/0	0/0	1125/0	0/0
N	3674	2549/0	0/0	0/0	0/0	1125/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, N

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.39 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-H.


END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING	CHORDS	MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX	UNBRAC	WEBS	MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX	UNBRAC
TOTAL LOAD CASES: (4)																		
	FR-TO																	
	A-B	-7647/0																
	B-C	-4073/0																
	C-D	-2323/0																
	D-E	-1116/0																
	E-F	-1139/0																
	F-G	-1139/0																
	G-H	-1794/0																
	H-A	-4952/0																
	N-M	0/0																
	M-L	0/7062																
	L-K	0/3776																
	K-J	0/3776																
	J-I	0/2139																
	I-H	0/0																

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TOTAL
	M	2-5-9	-4380	-4380		BACK	VERT	

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER MECHANICAL CONNECTION IS REQUIRED.



TOTAL WEIGHT = 4 X 123 = 494 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NSCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NSCC 2015
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(56 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAFT LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.75")
CALCULATED VERT. DEFL. (LL) = L/999 (0.08")
ALLOWABLE DEFL. (TL) = L/360 (0.75")
CALCULATED VERT. DEFL. (TL) = L/999 (0.14")

CSI: TC=0.46/1.00 (G-H), BC=0.69/1.00 (L-M), WB=0.97/1.00 (D-I), SS=0.13/1.00 (F-G-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 798 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (C) (INPUT = 0.90)
JSI METAL = 0.91 (H) (INPUT = 1.00)

Structural component only
DWG# T-1923501

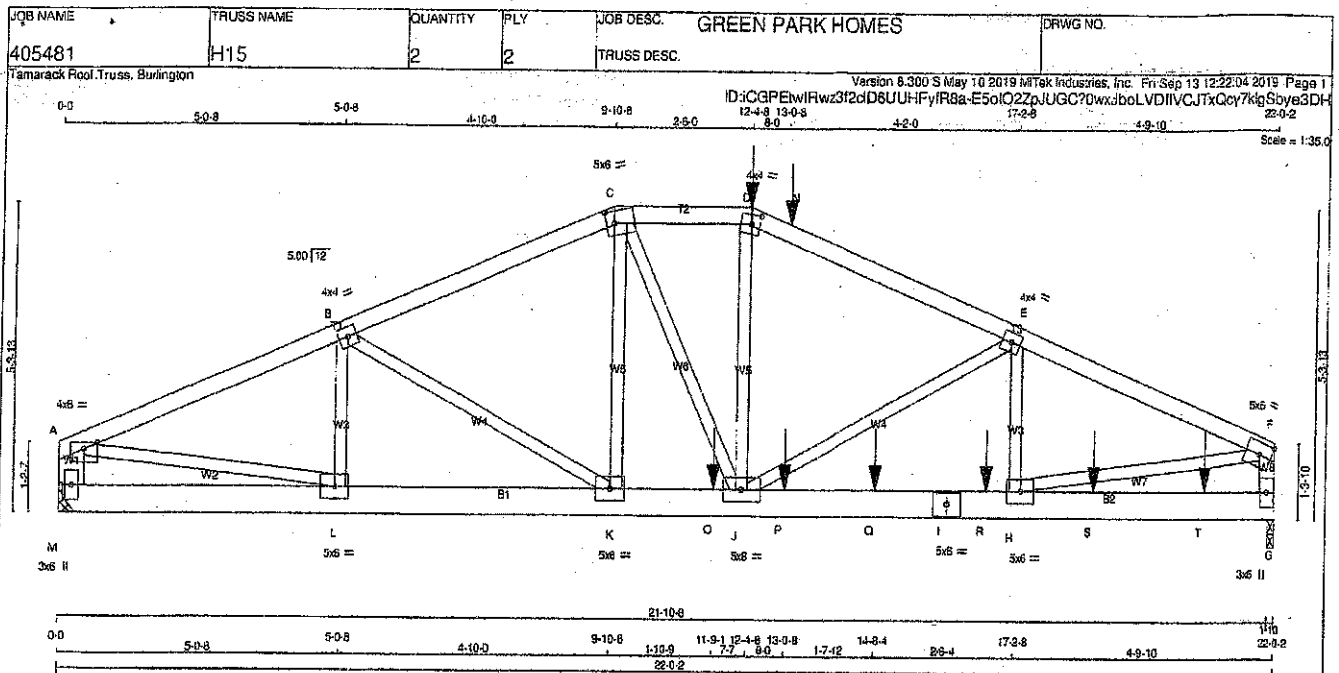

LUMBER

N.L.Q.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
M - A	2x6	DRY	No.2	SPF
M - I	2x6	DRY	No.2	SPF
I - G	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C 1	12	TOP
C-D 1	12	SIDE(61.0)
D-F 1	12	SIDE(61.0)
G-F 1	12	TOP
M-A 2	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
M-I 2	12	SIDE(0.0)
I-G 2	12	SIDE(0.0)
WEBS: (0.122"x3") SPIRAL NAILS		
J-D 1	6	SIDE(96.5)
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A TMVW-p	MT20	4.0	6.0	Edge	
B TMVW-l	MT20	4.0	4.0		
C TTWW-m	MT20	5.0	6.0	2.50	1.75
D TTWW-m	MT20	4.0	4.0	2.00	1.75
E TMVW-l	MT20	4.0	4.0		
F TMVW-l	MT20	5.0	6.0		Edge
G BMV-l-p	MT20	3.0	6.0		
H, K, L					
H BMVW-l	MT20	5.0	3.0		
I BS-l	MT20	5.0	3.0		
J BMVW-l	MT20	3.0	3.0		
M BMV-l-p	MT20	3.0	3.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	UPLIFT	IN-SX
M	2256	0	0	MECHANICAL
G	2527	0	0	1-10

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT M. MINIMUM BEARING LENGTH AT JOINT M = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
M	1582	1115 / 0	0 / 0	0 / 0	0 / 0	487 / 0	0 / 0
G	1777	1224 / 0	0 / 0	0 / 0	0 / 0	553 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4-4 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10-0 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	FORCE (LBS)	CHORDS		WEBS	
		MAX. FACTORED	FACTORED	MAX. FACTORED	MAX. FACTORED
FR-TO					
A-B	-3688 / 0	-102.0	-102.0	0.29 (1)	4.64
B-C	-3543 / 0	-102.0	-102.0	0.28 (1)	4.68
C-D	-3584 / 0	-102.0	-102.0	0.10 (1)	4.83
D-N	-3888 / 0	-102.0	-102.0	0.30 (1)	4.47
N-E	-3889 / 0	-102.0	-102.0	0.30 (1)	4.47
E-F	-3884 / 0	-102.0	-102.0	0.30 (1)	4.48
G-F	-2439 / 0	0.0	0.0	0.13 (1)	7.23
M-A	-2184 / 0	0.0	0.0	0.08 (1)	7.81
M-L	0 / 0	-18.5	-18.5	0.05 (1)	10.00
L-K	0 / 3423	-18.5	-18.5	0.27 (1)	10.00
K-O	0 / 3349	-18.5	-18.5	0.33 (1)	10.00
O-J	0 / 3349	-18.5	-18.5	0.33 (1)	10.00
J-P	0 / 3698	-18.5	-18.5	0.29 (1)	10.00
P-Q	0 / 3698	-18.5	-18.5	0.29 (1)	10.00
Q-I	0 / 3698	-18.5	-18.5	0.29 (1)	10.00
I-R	0 / 3698	-18.5	-18.5	0.29 (1)	10.00
R-H	0 / 3698	-18.5	-18.5	0.28 (1)	10.00
H-S	0 / 0	-18.5	-18.5	0.08 (1)	10.00
S-T	0 / 0	-18.5	-18.5	0.08 (1)	10.00
T-G	0 / 0	-18.5	-18.5	0.05 (1)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.
D	12-4-8	-125	-140		FRONT	VERT
D	12-4-8	-713	-713		FRONT	VERT
N	13-0-8	-140	-140		FRONT	VERT
O	11-9-1	-1018	-1018		FRONT	VERT
P	13-0-8	-27	-27		FRONT	VERT
Q	14-8-4	-27	-27		FRONT	VERT
R	16-8-4	-27	-27		FRONT	VERT
S	18-8-4	-27	-27		FRONT	VERT
T	20-8-4	-27	-27		FRONT	VERT

CONNECTION REQUIREMENTS

1) CH: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***

GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.

LOADS WERE DERIVED FROM USER INPUT

NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 29.0 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 42.4 PSF

SPACING = 210 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDT USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2018, NBC 2012
- CSA C86-09, CSA C86-14
- TPC 2011, TPC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.73")

CALCULATED VERT. DEFL.(LL) = L/599 (0.07")

ALLOWABLE DEFL.(TL) = L/360 (0.73")

CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.30/1.00 (D-E:1), SC=0.33/1.00 (J-K:1), WB=0.47/1.00 (F-H:1), SSI=0.27/1.00 (J-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618	354	1687
	788	1987	1556

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (A) (INPUT = 0.90)

JSI METAL = 0.50 (F) (INPUT = 1.00)

Structural component only


DWG# T-1923502

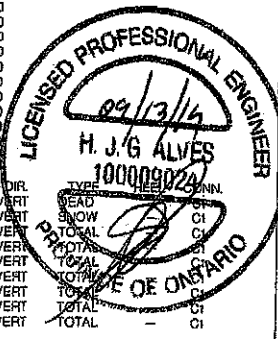

JOB NAME 405481	TRUSS NAME H17	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.300 S May 10 2018 MITek Industries, Inc. Fri Sep 13 12:22:05 2019 Page 1
ID:CGPEtWIRwz3I2dD8UUFyIRBa-fHMgbCaR4nQ3dAU8sJa1QDvxbTgou5LOUE?1ye3DG

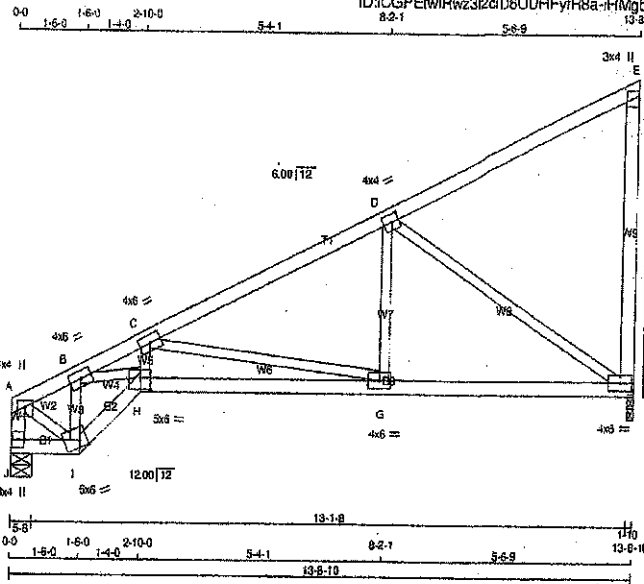

Scale = 1:42.0

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - E	2x4 DRY	No.2	SPF
F - E	2x4 DRY	No.2	SPF
J - A	2x4 DRY	No.2	SPF
J - I	2x4 DRY	No.2	SPF
I - H	2x4 DRY	No.2	SPF
H - F	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			
DRY, SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
JT	VERT	DOWN	HORZ	UPLIFT	IN-SX
F	827	0	827	0	1-10
J	827	0	827	0	5-8

UNFACTORED REACTIONS		1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	582	388 / 0	0 / 0	0 / 0	0 / 0	184 / 0	0 / 0	0 / 0
J	COMBINED	582	388 / 0	0 / 0	0 / 0	0 / 0	184 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.41 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MAX. FACTORED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)
PR-TO										
A-B	-778 / 0		-102.0	-102.0	0.05 (1)	6.25	1-8	-975 / 0	0.14 (1)	
B-C	-2318 / 0		-102.0	-102.0	0.12 (1)	4.41	B-H	0 / 1490	0.34 (1)	
C-D	-949 / 0		-102.0	-102.0	0.38 (1)	5.88	H-C	0 / 498	0.11 (1)	
D-E	-28 / 0		-102.0	-102.0	0.37 (1)	5.25	C-G	-1196 / 0	0.58 (1)	
E-F	-220 / 0		0.0	0.0	0.20 (1)	7.81	G-D	0 / 384	0.08 (1)	
J-A	-813 / 0		0.0	0.0	0.08 (1)	7.81	D-F	-1038 / 0	0.78 (1)	
J-I	0 / 0		-18.5	-18.5	0.01 (4)	10.00	A-I	0 / 784	0.18 (1)	
I-H	0 / 877		-18.5	-18.5	0.15 (1)	10.00				
H-G	0 / 2045		-18.5	-18.5	0.41 (1)	10.00				
G-F	0 / 870		-18.5	-18.5	0.22 (4)	10.00				

TOTAL WEIGHT = 4 X 58 = 230 lb (M/F)

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL =	29.0 PSF
DL =	6.0 PSF
BOT CH. LL =	0.0 PSF
DL =	7.4 PSF
TOTAL LOAD =	42.4 PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.46")
CALCULATED VERT. DEFL. (LL) = L/899 (0.06")
ALLOWABLE DEFL. (TL) = L/360 (0.46")
CALCULATED VERT. DEFL. (TL) = L/998 (0.11")

CSI: TC=0.38/1.00 (C-D:1), BC=0.41/1.00 (G-H:1), WB=0.78/1.00 (D-F:1), SSI=0.24/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.



NAIL VALUES	
PLATE GRIP (DRY)	SHEAR SECTION
(PSI)	(PLI)
MAX MIN	MAX MIN
MT20	613 354 1667 785 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (B) (INPUT = 0.90)
JSI METAL = 0.40 (B) (INPUT = 1.00)

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMVW+p	MT20	4.0	4.0 1.50 2.00
B	TMVW+H	MT20	4.0	6.0
C	TMVW+H	MT20	4.0	6.0
D	TMVW+H	MT20	4.0	4.0 2.00 1.75
E	TMV+p	MT20	3.0	4.0
F	BMVW+H	MT20	4.0	6.0
G	BMVW+H	MT20	4.0	6.0
H	BMVW+p	MT20	5.0	6.0 3.00 2.75
I	BMVW+m	MT20	5.0	6.0 1.75 2.00
J	BMV+H	MT20	3.0	4.0

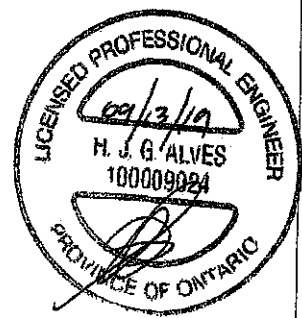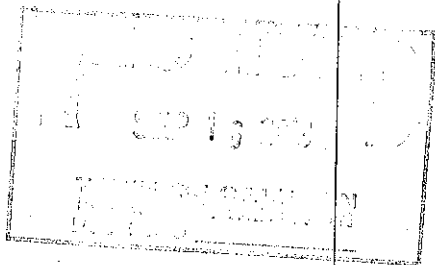

Structural component only
DWG# T-1923503

Tamarack Roof Truss, Burlington



DRY: SEASONED LUMBER

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

SEP 12 1965

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT 1. MINIMUM BEARING LENGTH AT JOINT 1 $\geq 4-0$.

UNFACTORED REACTIONS

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

2x6 DRY SPF No.2 BEARING BLOCK 12' LONG AT JT. E ATTACHED TO FRONT SIDE WITH 3 ROWS OF (0.122"x3") SPIRAL NAILS SPACED 9" C.C. 12 NAILS TOTAL.

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.83 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-E, G-E.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIP
K	1-9-10	-1174	-1174	---	FRONT	VERT
J	3-9-10	-1174	-1174	---	FRONT	VERT
L	5-9-10	-1174	-1174	---	FRONT	VERT
M	7-9-10	-1174	-1174	---	FRONT	VERT
N	9-9-10	-1174	-1174	---	FRONT	VERT
O	11-9-10	-1174	-1174	---	FRONT	VERT

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL	=	29.0	PSF
		DL	=	6.0	PSF
BOT	CH.	LL	=	0.0	PSF
		DL	=	7.4	PSF
TOTAL LOAD				=	42.4 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012
- CSA 388-09, CSA 588-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.46")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL)= L/360 (0.46")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.33/1.00 (A-B:1), BC=0.78/1.80 (G-H:1),
WB=0.64/1.00 (A-H:1), SSI=0.59/1.00 (E-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

	NAIL VALUES					
	PLATE GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PL)		(PL)	
	MAX	MIN	MAX	MIN	MAX	MIN
WT20	818	354	1667	788	1987	1856

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

SI GRIP = 0.90 (C) (INPUT = 0.90)
SI METAL = 0.56 (C) (INPUT = 1.00)

Structural component only
DWG# T-1923504

JOB NAME 405481	TRUSS NAME H19	QUANTITY 12	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	-----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington Version 8.300 S May 10 2019 M/Tek Industries, Inc. Fri Sep 13 12:22:07 2019 Page 1

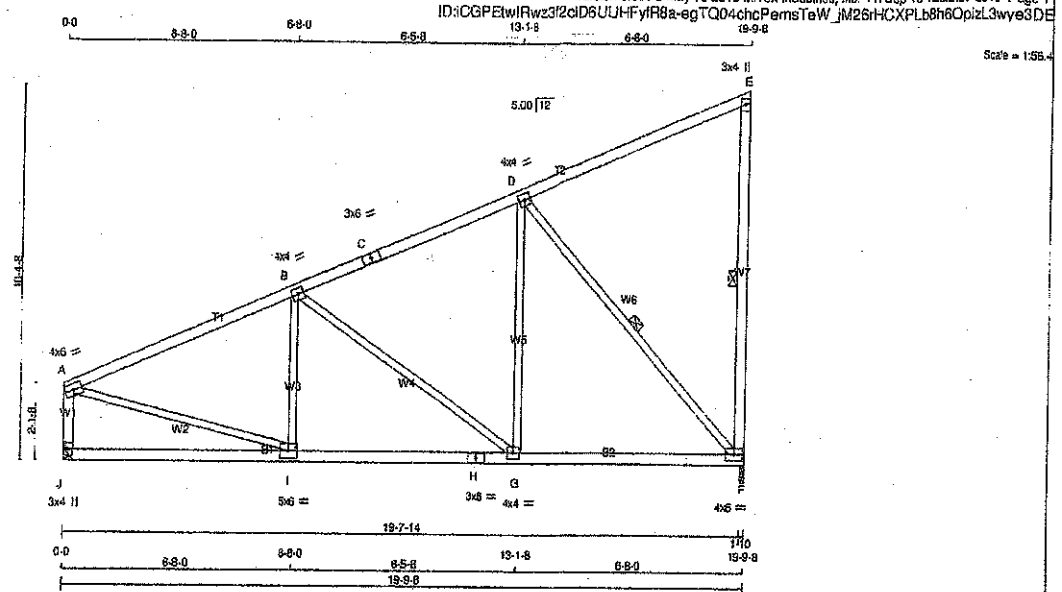

LUMBER

N.L.G.A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
F - H	2x4	DRY	No.2
J - A	2x4	DRY	No.2
J - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVV-1	MT20	4.0	6.0		
B	TMWW-1	MT20	4.0	4.0		
C	TS-1	MT20	3.0	6.0		
D	TMWW-1	MT20	4.0	4.0		
E	TMV+p	MT20	3.0	4.0		
F	BMVW-1	MT20	4.0	6.0		
G	BMWW-1	MT20	4.0	4.0		
H	BS-1	MT20	3.0	6.0		
I	BMVW-1	MT20	5.0	6.0		
J	BMV-1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

SPF	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	GROSS REACTION	DOWN	BRG
F	1193	0	1193	0
J	1193	0	1193	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS
F	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
F	839	574 / 0 0 / 0 0 / 0 0 / 0 265 / 0 0 / 0
J	839	574 / 0 0 / 0 0 / 0 0 / 0 265 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.85 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-F, D-F.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC: MAX (PLF) CSI (LC) UNBRAC LENGTH	MEMB. FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO				
A-B	-1333 / 0	-102.0 -102.0 0.57 (1) 4.85	I-B	-213 / 42 0.08 (1)
B-C	-859 / 0	-102.0 -102.0 0.48 (1) 5.90	G-B	-564 / 0 0.74 (1)
C-D	-859 / 0	-102.0 -102.0 0.48 (1) 5.90	G-D	0 / 481 0.10 (1)
D-E	-25 / 0	-102.0 -102.0 0.52 (1) 6.25	D-F	-1176 / 0 0.80 (1)
E-F	-274 / 0	0.0 0.0 0.15 (1) 6.25	A-I	0 / 1299 0.29 (1)
J-A	-1141 / 0	0.0 0.0 0.13 (1) 7.44		
J-I	0 / 0	-18.5 -18.5 0.18 (4) 10.00		
I-H	0 / 1253	-18.5 -18.5 0.30 (1) 10.00		
H-G	0 / 1253	-18.5 -18.5 0.30 (1) 10.00		
G-F	0 / 794	-18.5 -18.5 0.25 (4) 10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.0 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. LC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.86")
CALCULATED VERT. DEFL.(LL) = 0.999 (0.04")
ALLOWABLE DEFL.(TL) = L/360 (0.86")
CALCULATED VERT. DEFL.(TL) = 0.999 (0.09")

CSI: TC=0.57/1.00 (A-B:1), BC=0.30/1.00 (G-I:1),

WB=0.80/1.00 (D-F:1), SB=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1687
	788	1987	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.74 (D) (INPUT = 0.90)

JSI METAL = 0.39 (H) (INPUT = 1.00)





Structural component only
DWG# T-1923505

JOB NAME 405481	TRUSS NAME H19S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Tramrack Roof Truss, Burlington

Version 6.300 S May 10 2019 MTEK Industries, Inc. Fri Sep 13 12:22:08 2019 Page 1

ID:CGPEtwRwz3f2dD6UuHFyR8a-7s1oECqNmdUdYQIHf3qUmpIH8Y1MjubMye3DD

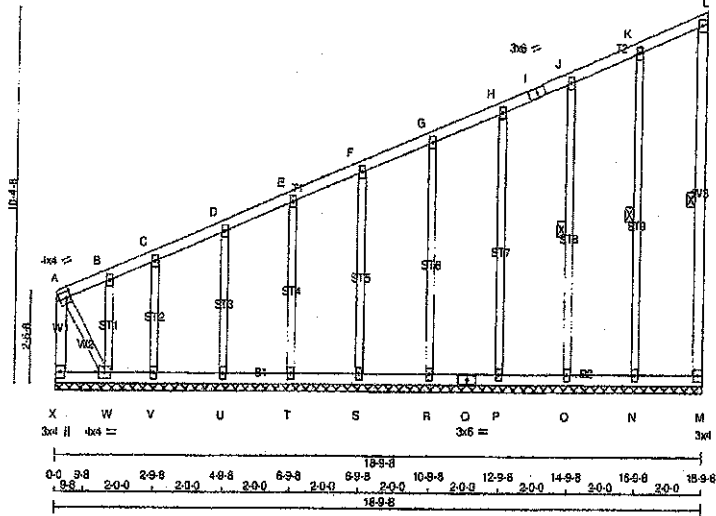

TOTAL WEIGHT = 2 X 102 = 204 lb

CHORDS	SIZE	DRY	NUMBER
A - L	2x4	DRY	No.2
I - L	2x4	DRY	No.2
M - L	2x4	DRY	No.2
X - A	2x4	DRY	No.2
X - Q	2x4	DRY	No.2
Q - M	2x4	DRY	No.2

ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER			

GABLE STUDS SPACED AT 24-0 OC.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A - TMVW-I	MT20	4.0	4.0	2.00	1.50
B, C, D, E, F, G, H, J, K					
B - TMVW-I	MT20	2.0	4.0		
I - TS-I	MT20	3.0	6.0		
L - TMVW-I	MT20	3.0	4.0		
M - BMVW-I	MT20	3.0	4.0		
N, O, P, R, S, T, U, V					
N - BMVW-I	MT20	2.0	4.0		
Q - RS-I	MT20	3.0	6.0		
W - BMVW-I	MT20	4.0	4.0		
X - BMVW-I	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF L-M, K-N, J-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)
FR-TO						FR-TO			
A-B	-15 / 0	-102.0	-102.0	0.02 (1)	6.25	N-K	-227 / 0	0.14 (1)	
B-C	-15 / 0	-102.0	-102.0	0.03 (1)	6.25	O-J	-201 / 0	0.10 (1)	
C-D	-12 / 0	-102.0	-102.0	0.05 (1)	6.25	P-H	-203 / 0	0.24 (1)	
D-E	-11 / 0	-102.0	-102.0	0.05 (1)	6.25	R-G	-203 / 0	0.17 (1)	
E-F	-8 / 0	-102.0	-102.0	0.05 (1)	10.00	S-F	-203 / 0	0.13 (1)	
F-G	-6 / 0	-102.0	-102.0	0.05 (1)	10.00	T-E	-202 / 0	0.09 (1)	
G-H	-5 / 0	-102.0	-102.0	0.05 (1)	10.00	U-D	-209 / 0	0.08 (1)	
H-I	-3 / 0	-102.0	-102.0	0.06 (1)	10.00	V-C	-188 / 0	0.04 (1)	
I-J	-3 / 0	-102.0	-102.0	0.05 (1)	10.00	W-B	-144 / 0	0.03 (1)	
J-K	0 / 0	-102.0	-102.0	0.05 (1)	10.00	A-W	0 / 34	0.01 (1)	
K-L	-7 / 0	-102.0	-102.0	0.05 (1)	10.00				
M-L	-86 / 0	0.0	0.0	0.05 (1)	8.25				
X-A	-97 / 0	0.0	0.0	0.01 (1)	7.81				
X-W	0 / 0	-18.5	-18.5	0.01 (4)	10.00				
W-V	0 / 16	-18.5	-18.5	0.01 (4)	10.00				
V-U	0 / 13	-18.5	-18.5	0.02 (4)	10.00				
U-T	0 / 10	-18.5	-18.5	0.02 (4)	10.00				
T-S	0 / 8	-18.5	-18.5	0.01 (4)	10.00				
S-R	0 / 6	-18.5	-18.5	0.01 (4)	10.00				
R-Q	0 / 4	-18.5	-18.5	0.01 (4)	10.00				
Q-P	0 / 4	-18.5	-18.5	0.01 (4)	10.00				
P-O	0 / 3	-18.5	-18.5	0.01 (4)	10.00				
O-N	0 / 1	-18.5	-18.5	0.02 (4)	10.00				
N-M	0 / 0	-18.5	-18.5	0.02 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	29.0	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	42.4	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

CS1: TC=0.05/1.00 (K-L-1), BC=0.02/1.00 (N-O-1), WB=0.24/1.00 (H-P-1), SS=0.09/1.00 (K-L-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1667


MAX MIN MAX MIN MAX MIN

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP=0.53 (A) (INPUT = 0.50)

JSI METAL=0.08 (C) (INPUT = 1.00)

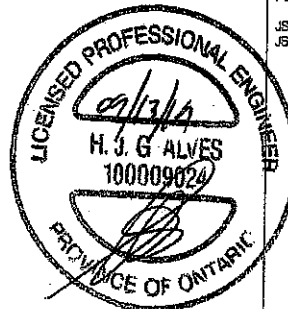


Structural component only
DWG# T-1923506

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
405481	H20	6	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.300 S May 10 2019 Mitek Industries, Inc. Fri Sep 13 12:22:09 2019 Page 1

ID:CGPEIwIRwz3f2dD6UHFYR8a-b2bBRdx8QuJ8nov58OWCGMaVD2KckFhG?SR8pye3DC

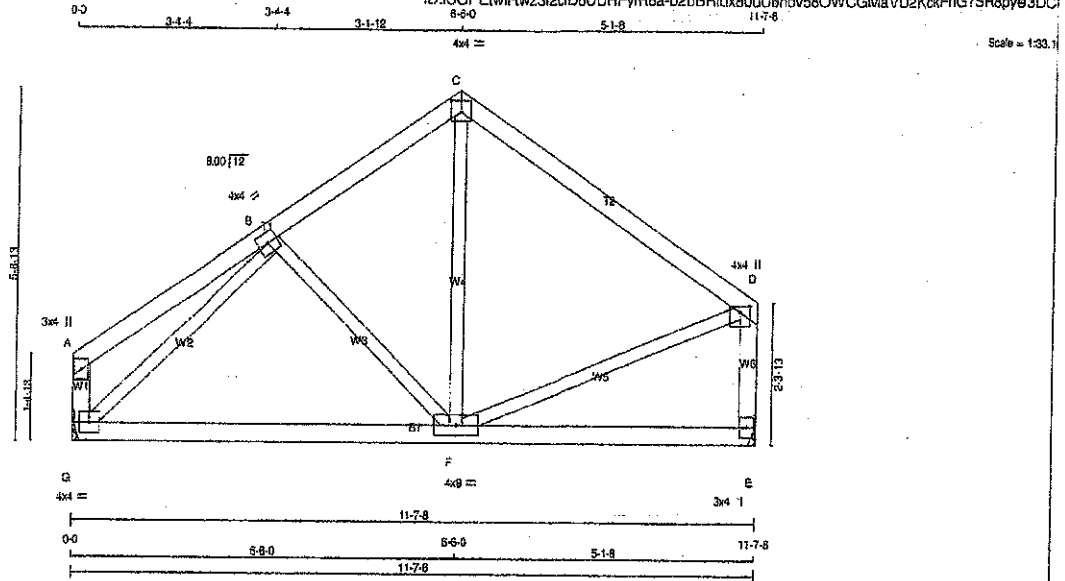

TOTAL WEIGHT = 6 X 48 = 288 lb

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
G - A	2x4	DRY	No.2
E - D	2x4	DRY	No.2
G - E	2x4	DRY	No.2

ALL WEBS - 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B	TMVW-1	MT20	4.0	4.0		
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMV1+p	MT20	3.0	4.0		
F	BMVW-1	MT20	4.0	4.0		
G	BMVW1-t	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED		MAXIMUM FACTORED			INPUT	REQD
	GROSS REACTION		GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	701	0	701	0	0	MECHANICAL	
G	701	0	701	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E, G. MINIMUM BEARING LENGTH AT JOINT E = 1-6. JOINT G = 1-8.

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	493	337/0	0/0	0/0	0/0	156/0	0/0
G	493	337/0	0/0	0/0	0/0	156/0	0/0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE	VERT. LOAD	MAX.	MAX.	MEMB.	FORCE	MAX.
	(LBS)	LC1	CSI (LC)	UNBRAC		(LBS)	CSI (LC)
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 21	-102.0 -102.0	0.17 (1)	10.00	B-F	-197 / 0	0.07 (1)
B-C	-483 / 0	-102.0 -102.0	0.13 (1)	6.25	F-C	0 / 123	0.04 (4)
C-D	-482 / 0	-102.0 -102.0	0.35 (1)	6.25	G-B	-742 / 0	0.25 (1)
G-A	-127 / 0	0.0 0.0	0.01 (1)	7.81	F-D	0 / 413	0.09 (1)
E-D	-668 / 0	0.0 0.0	0.08 (1)	7.81			
G-F	0 / 525	-18.5 -18.5	0.22 (4)	10.00			
F-E	0 / 0	-18.5 -18.5	0.19 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 29.0 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 42.4 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65 % OF 37.5 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/399 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/399 (0.05")

CSI: TC=0.35/1.00 (C-D-1), BC=0.22/1.00 (F-G-4), WB=0.25/1.00 (B-G-1), SSI=0.17/1.00 (C-D-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	818	354	1657
		788	1987
			1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.84 (B) (INPUT = 0.90)
JSI METAL = 0.26 (B) (INPUT = 1.00)

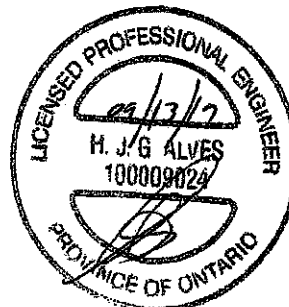

Structural component only
DWG# T-1923507

JOB NAME 405481	TRUSS NAME H20G	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

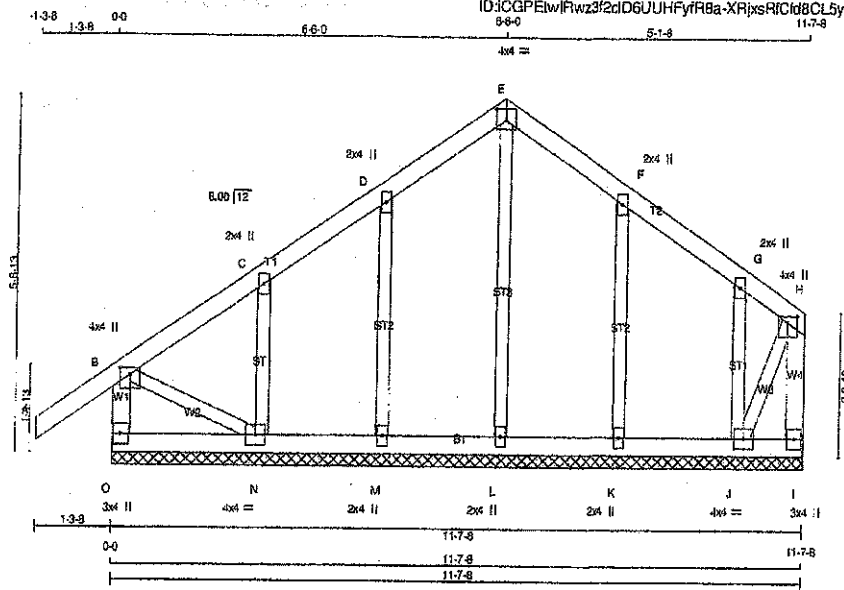

Scale = 1:32.7

TOTAL WEIGHT = 2 X 53 = 105 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
O - B	2x4	DRY No.2
A - E	2x4	DRY No.2
S - H	2x4	DRY No.2
I - H	2x4	DRY No.2
O - I	2x4	DRY No.2

ALL WEBS	2x3	DRY No.2
ALL GABLE WEBS	2x3	DRY No.2
DRY: SEASONED LUMBER.		

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C, D, F, G						
C	TMVW+p	MT20	2.0	4.0		
E	TTW+p	MT20	4.0	4.0	2.25	2.00
H	TMVW+p	MT20	4.0	4.0	1.25	2.00
I	BMV1+p	MT20	3.0	4.0		
J	BMVW1+p	MT20	4.0	4.0		
K, L, M						
K	BMV1+p	MT20	2.0	4.0		
N	BMVW1+p	MT20	4.0	4.0		
O	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (L/C)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (L/C)
FR-TO				FR-TO			
O-B	-267 / 0	0.0	0.03 (1)	L-E	-156 / 0	0.08 (1)	
A-B	0 / 39	-102.0	-102.0 0.14 (1)	M-D	-216 / 0	0.06 (1)	
B-C	-16 / 0	-102.0	-102.0 0.07 (1)	H-C	-251 / 0	0.05 (1)	
C-D	-24 / 0	-102.0	-102.0 0.07 (1)	K-F	-238 / 0	0.07 (1)	
D-E	-25 / 0	-102.0	-102.0 0.05 (1)	J-G	-163 / 0	0.03 (1)	
E-F	-26 / 0	-102.0	-102.0 0.05 (1)	B-N	0 / 26	0.01 (1)	
F-G	-14 / 0	-102.0	-102.0 0.06 (1)	J-H	0 / 44	0.01 (1)	
G-H	-14 / 0	-102.0	-102.0 0.03 (1)				
I-H	-84 / 0	0.0	0.0 0.01 (1)				
O-N	0 / 0	-18.5	-18.5 0.03 (4)				
N-M	0 / 18	-18.5	-18.5 0.03 (4)				
M-L	0 / 12	-18.5	-18.5 0.02 (4)				
L-K	0 / 12	-18.5	-18.5 0.02 (4)				
K-J	0 / 17	-18.5	-18.5 0.02 (4)				
J-I	0 / 0	-18.5	-18.5 0.01 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 29.0 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 42.4 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012
- CSA 088-06, CSA 085-14
- TPIC 2011, TPIC 2014

(55% OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

CS: TC=0.14/1.00 (A-B:1), BC=0.03/1.00 (M-N:4), WB=0.08/1.00 (E-L:1), SS=0.09/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (B) (INPUT = 0.90)
JSI METAL = 0.13 (C) (INPUT = 1.00)



Structural component only
DWG# T-1923508

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
405481	H21G	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

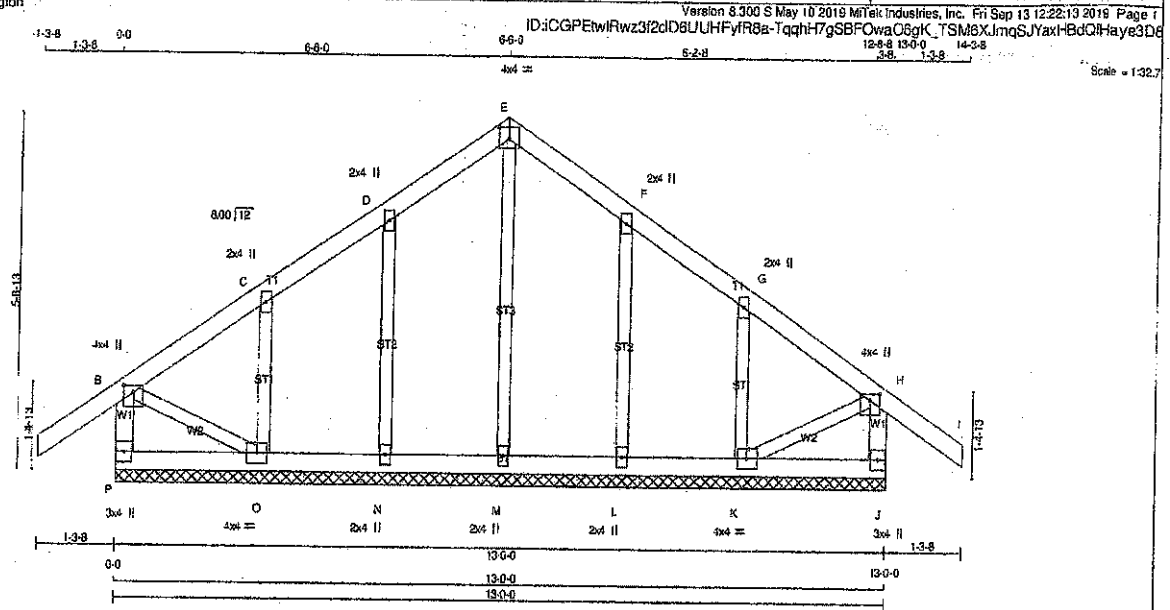

TOTAL WEIGHT = 2 X 57 = 114 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
P - B	2x4	DRY	No.2	SPF	
A - E	2x4	DRY	No.2	SPF	
E - I	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
P - H	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
ALL GABLE WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table is in inches)

J TYPE	PLATES	W	LEN	Y	X
B TMW+p	MT20	4.0	4.0	1.25	2.00
C, D, F, G					
C TMW+w	MT20	2.0	4.0		
E TTW+p	MT20	4.0	4.0	2.25	2.00
H TMW+p	MT20	4.0	4.0	1.25	2.00
J BMV1+p	MT20	3.0	4.0		
K BMW1-t	MT20	4.0	4.0		
L, M, N					
L BMW1+w	MT20	2.0	4.0		
O BMW1-t	MT20	4.0	4.0		
P BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FORCE (LBS)	MAX. CSI (LC)	MAX. CSI (LC)
FR-TO		FROM TO		FR-TO			
P-B	-272.0	0.0	0.03 (1)	M-E	-153.0	0.07 (1)	
A-B	0.39	-102.0	-102.0 0.14 (1)	N-D	-216.0	0.05 (1)	
B-C	-21.0	-102.0	-102.0 0.07 (1)	O-C	-251.0	0.05 (1)	
C-D	-29.0	-102.0	-102.0 0.07 (1)	L-F	-216.0	0.06 (1)	
D-E	-30.0	-102.0	-102.0 0.05 (1)	K-G	-251.0	0.05 (1)	
E-F	-30.0	-102.0	-102.0 0.05 (1)	B-O	0.31	0.01 (1)	
F-G	-29.0	-102.0	-102.0 0.07 (1)	K-H	0.31	0.01 (1)	
G-H	-21.0	-102.0	-102.0 0.07 (1)				
H-I	0.39	-102.0	-102.0 0.14 (1)				
J-H	-272.0	0.0	0.03 (1)				
P-O	0.0	-18.5	-18.5 0.03 (4)				
O-N	0.21	-18.5	-18.5 0.03 (4)				
N-M	0.16	-18.5	-18.5 0.02 (4)				
M-L	0.21	-18.5	-18.5 0.02 (4)				
L-K	0.21	-18.5	-18.5 0.03 (4)				
K-J	0.0	-18.5	-18.5 0.03 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 29.0	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 42.4	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.14/1.00 (A-B:1), BC=0.03/1.00 (N-O:4), WS=0.07/1.00 (E-M:1), SS=0.09/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.19 (H) (INPUT = 0.90)
JSI METAL = 0.13 (C) (INPUT = 1.00)

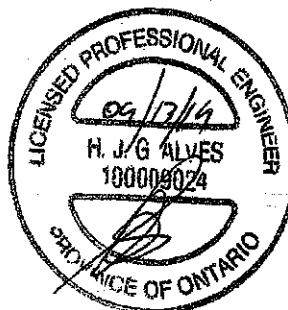

Structural component only
DWG# T-1923557

JOB NAME 405481	TRUSS NAME H26	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO
Tamarack Roof Truss, Burlington				Version 8.300 S May 10 2019 MITek Industries, Inc. Fri Sep 13 12:22:14 2019 Page 1 ID:08dJueNb1pNAxJN9U?SyvCERz-x0C4UTh4yYXnCYgsuh_huk3UIEnFH2LQCHACp0ys3D7 4-4-0 4-7-0 3-0		

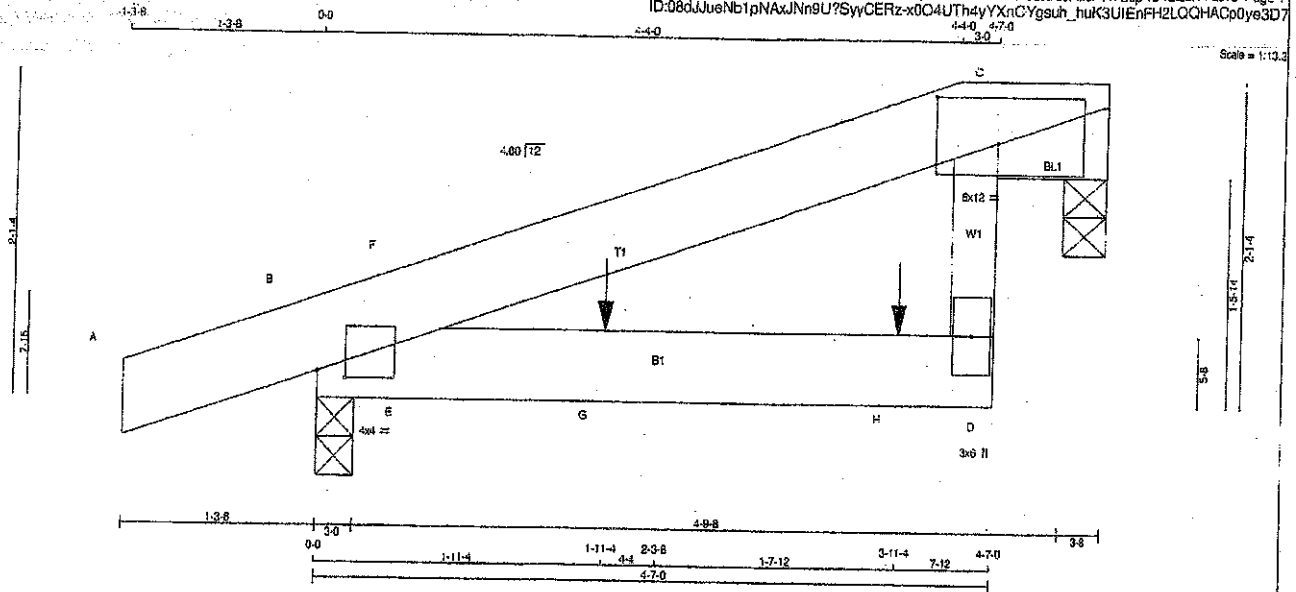

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x6	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
B - D	2x6	DRY	No.2	SPF

BEARING BLOCKS
BL1 2x6 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMB1-I	MT20	4.0	4.0	0.50	2.25
C TMBK1-p	MT20	6.0	12.0	3.50	5.00
D BMBV-p	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
C	298	0	298	0	3-8	3-8
B	425	0	425	0	3-0	3-0

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

JT	1ST LCASE		MAX/MIN. COMPONENT REACTIONS		PERM. LIVE WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	DOWN			
C	211	132/0	0/0	0/0	0/0	78/0	0/0
B	288	211/0	0/0	0/0	0/0	87/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	FACTORED			MEMB.	FORCE (LBS)	MAX. FACTORED CSI (LC)
		VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC			
FR-TO		FROM	TO	LENGTH	FR-TO		
A-B	0/13	-102.0	-102.0	0.07 (1)	10.00	E-F	-214/28 0.00 (1)
B-F	-31/0	-102.0	-102.0	0.04 (4)	6.25		
F-C	0/3	-102.0	-102.0	0.15 (1)	10.00		
D-C	0/92	0.0	0.0	0.02 (4)	10.00		
B-E	0/0	-18.5	-18.5	0.11 (1)	10.00		
E-G	0/0	-18.5	-18.5	0.11 (1)	10.00		
G-H	0/0	-18.5	-18.5	0.11 (1)	10.00		
H-D	0/0	-18.5	-18.5	0.11 (1)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
G	1-11-4	-13	-14	---	FRONT	VERT	TOTAL	---	C1
H	3-11-4	-17	-17	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.0 PSF
DL = 5.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = 1/989 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = 1/999 (0.02")

CS1: TC=0.15/1.00 (C-F:1), BC=0.11/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SH=0.16/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MAX	MIN	MAX	MIN
MT20	018	354	1367
	783	1987	1956

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.19 (B) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)

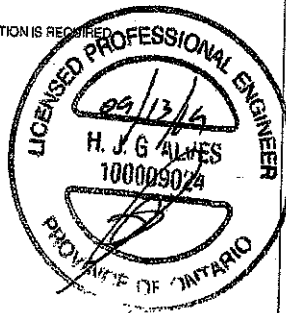


Structural component only
DWG# T-1923558

JOB NAME: 405481 TRUSS NAME: J1 QUANTITY: 22 PLY: 1 JOB DESC: GREEN PARK HOMES TRUSS DESC: DRWG NO. ID: CGPEtWlRwz3/2cID6UHFYR8a-PCySipjlsqIF3SPVwRXcy?d6B0VbaaxvmlLSys3D6

Tamarack Roof Truss, Burlington

Version 8.300 \$ May 10 2019 Mitek Industries, Inc. Fri Sep 13 12:22:15 2019 Page 1

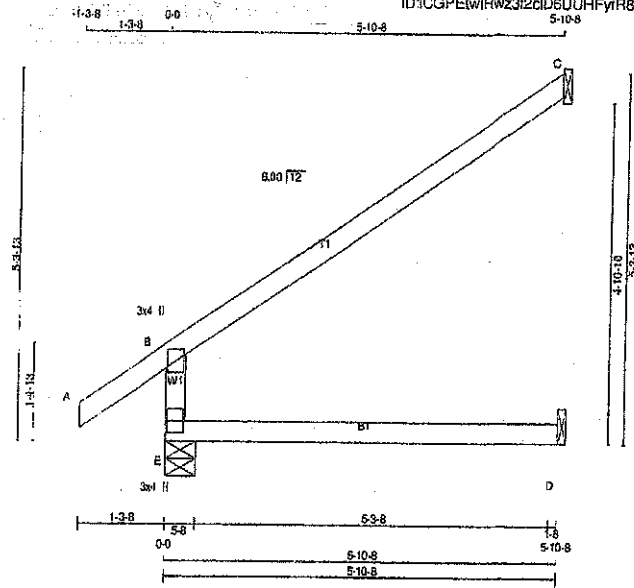

Scale = 1:25.2

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	JT	HORZ	JT	IN-SX	JT	IN-SX
E	578	0	578	0	5-8	5-8	
C	225	0	225	0	1-8	1-8	
D	46	0	51	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		MAX/MIN COMPONENT REACTIONS		LIVE		WIND		DEAD		SOIL	
JT	COMBINED	JT	SNOW	JT	PERM	JT	WIND	JT	DEAD	JT	SOIL
E	404	293/0	0/0	0/0	0/0	111/0	0/0	0/0	0/0	0/0	0/0
C	154	128/0	0/0	0/0	0/0	26/0	0/0	0/0	0/0	0/0	0/0
D	36	0/0	0/0	0/0	0/0	36/0	0/0	0/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	LC1 MAX (PLF)	MEMB.	FORCE (LBS)	MAX. FACTORED (LBS)	MAX. FACTORED (LBS)
FR-TO				FR-TO			
E-B	-515/0	0.0	0.0 0.12 (4)	7.81			
A-B	0/39	-102.0	-102.0 0.14 (1)	10.00			
B-C	-42/0	-102.0	-102.0 0.60 (1)	8.25			
E-D	0/0	-18.5	-18.5 0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012
- CSA 088-03, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.
(65% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.80/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (A:0), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (FL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.22 (B) (INPUT = 0.93)
JSI METAL = 0.17 (B) (INPUT = 1.00)

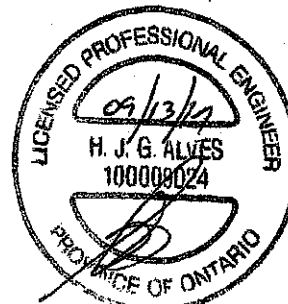

Structural component only
DWG# T-1923559

JOB NAME 405481	TRUSS NAME U3	QUANTITY 42	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.300'S May 10 2019 MTEK Industries, Inc. Fri Sep 13 12:22:17 2010 Page 1
ID:08dJlueNb1pNAXJNn9U?SyyCERz-Mb4C7VjyFTVM30PRZpXOWYhw9RoJUP5s5FOsQLye3D4

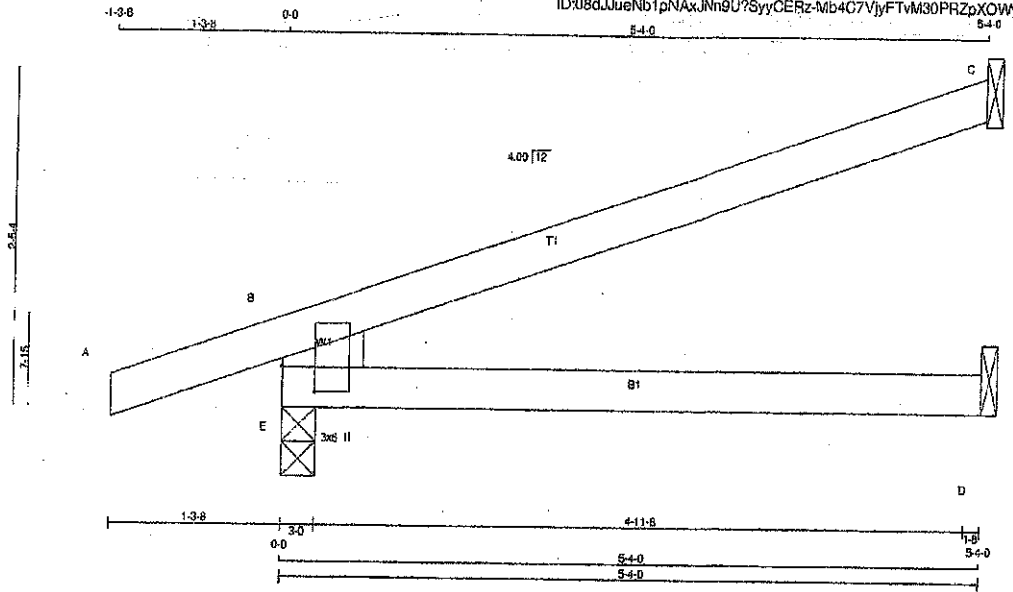

Scale = 1:14.8

LUMBER

N.L.G.A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x8	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	UPLIFT	IN-SX
E	538	0	0	3-0
C	204	0	0	1-8
D	37	0	0	1-8

TOTAL WEIGHT = 42 X 15 = 621 lb

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B						
E						
E	TMBMV1+p	MT20	3.0	6.0	2.25	2.75

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN	COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	COMBINED								
E	376	271/0	0/0	0/0	0/0	0/0	105/0	0/0	0/0
C	140	116/0	0/0	0/0	0/0	0/0	24/0	0/0	0/0
D	30	0/0	0/0	0/0	0/0	0/0	30/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CS (LC)	MAX. FACTORED CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)
FR-TO					FR-TO		
E-B	-477/0	0.0	0.0	0.05 (4)	7.81		
A-B	0.22	-102.0	-102.0	0.13 (1)	10.00		
B-C	-22/0	-102.0	-102.0	0.49 (1)	5.25		
E-D	0/0	-18.5	-18.5	0.15 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.
55% OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL(TL) = L/360 (0.19")
CALCULATED VERT. DEFL(TL) = 1/989 (0.02")

CSI: TC=0.49/1.00 (B-C:1), BC=0.15/1.00 (D-E:4), WB=0.00/1.00 (V=0), SS=0.25/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSH) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (E) (INPUT = 0.90)
JSI METAL = 0.09 (E) (INPUT = 1.00)

RECEIVED
SEP 13 2010
TAMARACK ROOF TRUSS
BURLINGTON

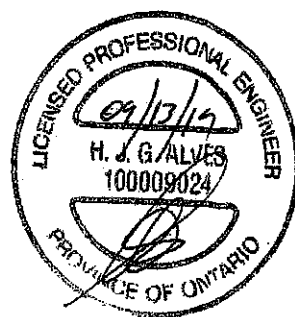

Structural component only
DWG# T-1923560


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
405481	J5	10	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.300 S May 10 2019 MTEK Industries, Inc. Fri Sep 13 12:22:20 2019 Page 1

ID:08dJueNb1pNAXJn9U?SyyCERz-mAmLWmryOHwT30fy656bJGmed1hmJqJcDdX1gye3D1

Scale = 1:10.4

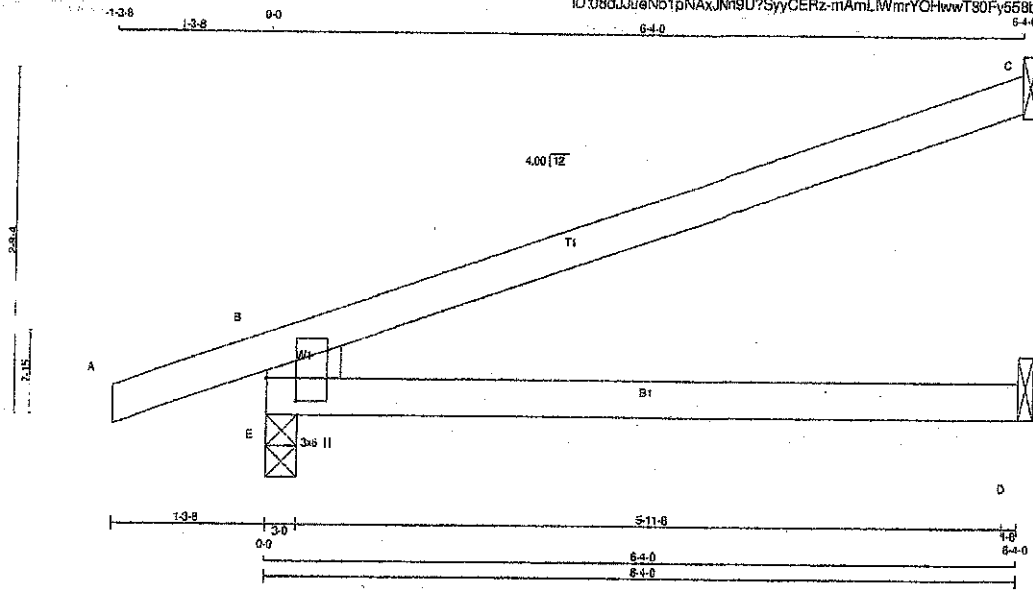

TOTAL WEIGHT = 10 X 17 = 171 lb (MIF)

LUMBER

N. L. G. A. RULES
CHORDS SIZE
E - B 2x8 DRY No.2
A - C 2x4 DRY No.2
E - D 2x4 DRY No.2

LUMBER
No.2
No.2
No.2

DESCR.
SPF
SPF
SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
E	813	0	813	0
C	242	0	242	0
D	44	0	50	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. SNOW	MIN. COMPONENT LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	429	307 / 0	0 / 0	0 / 0	0 / 0	122 / 0	0 / 0
C	166	138 / 0	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0
D	35	0 / 0	0 / 0	0 / 0	0 / 0	35 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)		
FR-TO		FROM TO			FR-TO				
E-B	-540 / 0	0.0 0.0	0.05 (4)	7.81					
A-B	0 / 22	-102.0 -102.0	0.13 (1)	10.00					
B-C	-26 / 0	-102.0 -102.0	0.54 (1)	6.25					
E-D	0 / 0	-18.5 -18.5	0.21 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, NBC 2012
- CSA C86-09, CSA C86-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.21")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.21")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.21/1.00 (D-E:4), WB=0.00/1.00 (A-B:0), SS=0.30/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY



TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1857 788 1967 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg

JSI GRIP = 0.27 (E) (INPUT = 0.80)
JSI METAL = 0.11 (E) (INPUT = 1.00)

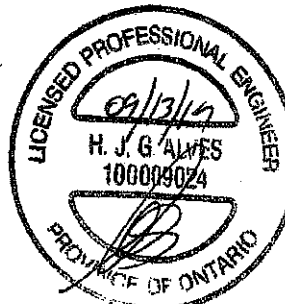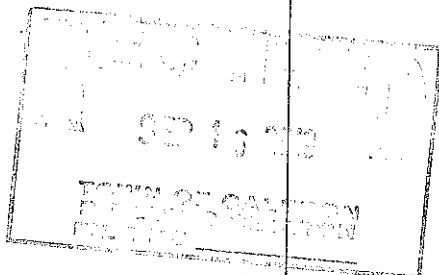


Structural component only
DWG# T-1923562

JOB NAME 405490	TRUSS NAME J13	QUANTITY 24	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.300 S May 10 2019 Mitek Industries, Inc. Fri Sep 13 10:59:25 2019 Page 1

ID:08dJLleNb1pMxJN9U18yCERz-x3facOYCsqUqZwJslckR7TmCsBSX(D1oi_nvXye4Qm

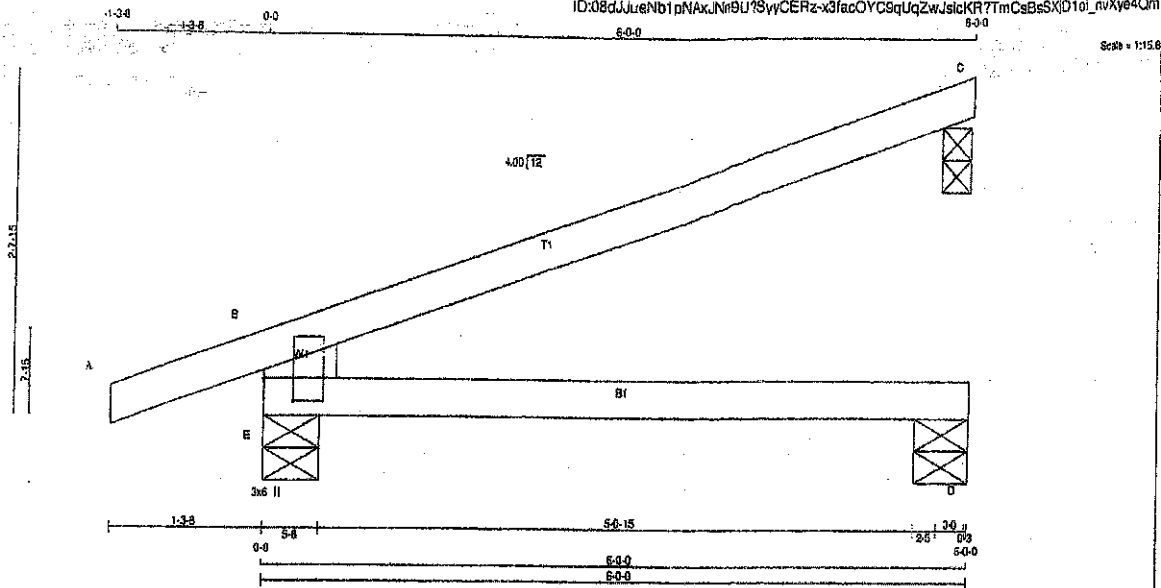

TOTAL WEIGHT = 24 X 16 = 382 lb

LUMBER
N. L. G. A. RULES
CHORDS SIZE
E - B 2x8 DRY No.2
A - C 2x4 DRY No.2
E - D 2x4 DRY No.2
DRY: SEASONED LUMBER.

DESCR.
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		RECORD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SK	IN-SK	
E	588	0	588	0	0	5-8	5-8	
C	230	0	230	0	0	3-0	3-0	
D	42	0	42	0	0	5-8	5-8	

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

JT	1ST CASE COMBINED		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM. LIVE	WIND			
E	411	288 / 0	0 / 0	0 / 0	0 / 0	118 / 0	0 / 0
C	156	131 / 0	0 / 0	0 / 0	0 / 0	27 / 0	0 / 0
D	34	0 / 0	0 / 0	0 / 0	0 / 0	34 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	FACTORED LGT. MAX. CS (LC)	MAX. UNBRACED LENGTH	MEMB.	WEBS MAX. FACTORED FORCE (LBS)	MAX. CS (LC)
PR-TO							
E-B	-519 / 0	0.0	0.0	0.08 (4)	7.01		
A-B	0 / 22	-102.0	-102.0	0.13 (1)	10.00		
B-C	-24 / 0	-102.0	-102.0	0.63 (1)	6.25		
E-D	0 / 0	-18.5	-18.5	0.19 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 20.0 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, NBC 2012
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 37.8 P.S.F. G.S.L. PLUS 3.4 P.S.F. RAIN LOAD) EQUALS 23.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.02")

CS: TC=0.63/1.00 (B-C:1), BC=0.19/1.00 (D-E:4),
WB=0.00/1.00 (n/a:D), SS=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)	PLI
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.26 (E) (INPUT = 0.50)
JSI METAL = 0.10 (E) (INPUT = 1.00)

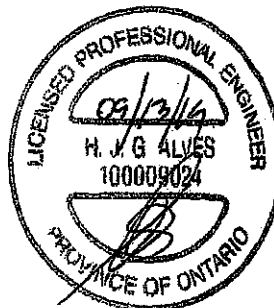

Structural component only
DWG# T-1923453

JOB NAME 405493	TRUSS NAME J14	QUANTITY 24	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
Tamarack Roof Truss, Burlington						

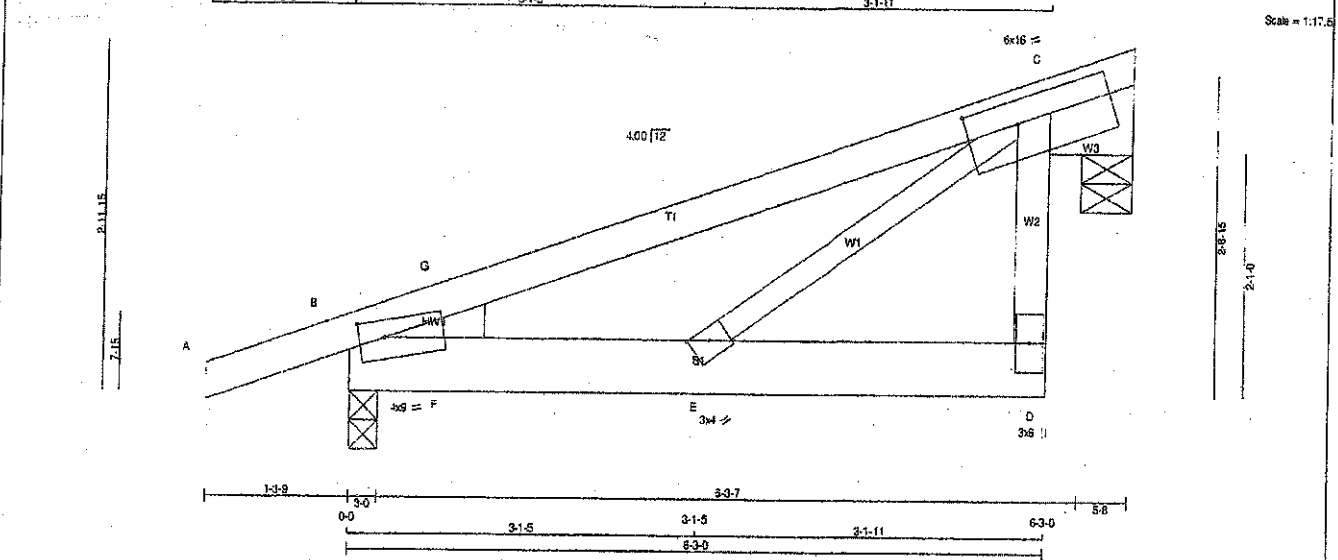

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
D - C	2x4	DRY	No.2
B - D	2x6	DRY	No.2
ALL WEBS: 2x3 DRY			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMBH1-m	MT20	4.0	9.0 1.75 2.75
C	TMVWW1-l	MT20	6.0	18.0 2.50 5.50
D	BMV+p	MT20	3.0	6.0
E	BMV+w	MT20	3.0	4.0 2.00 1.25

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	HEEL
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	WEDGE
C	377	0	377	0	5-8	5-8
B	513	0	513	0	3-0	3-0

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
C	265	181/0	0/0	0/0	0/0	84/0	0/0
B	359	259/0	0/0	0/0	0/0	100/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0/8	E-C	0/455
B-G	-263/0	F-G	-590/0
G-C	-394/0		
D-C	-6/24		
B-F	0/359		
F-E	0/359		
E-D	0/0		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.21")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.21")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.33/1.00 (C-G:1), BC=0.28/1.00 (B-F:1),
WB=0.10/1.00 (C-E:1), SS=0.24/1.00 (B-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.



NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.33 (E) (INPUT = 0.90)
JSI METAL= 0.11 (E) (INPUT = 1.00)

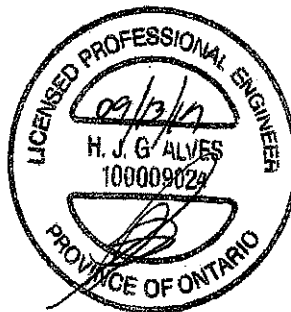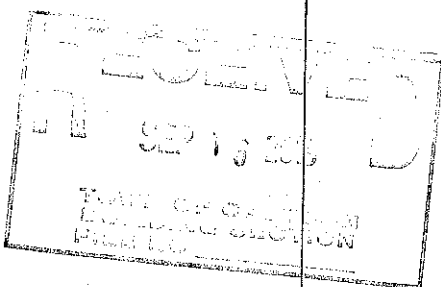

Structural component only
DWG# T-1923458



iSDesign™



Client:
Project:
Address:

Date: 2/2019
Designer:
Job Name: 405481
Project #:

Page 1 of 4

B1 S-P-F #2 2.000" X 10.000" 2-Ply - PASSED

Level: Level

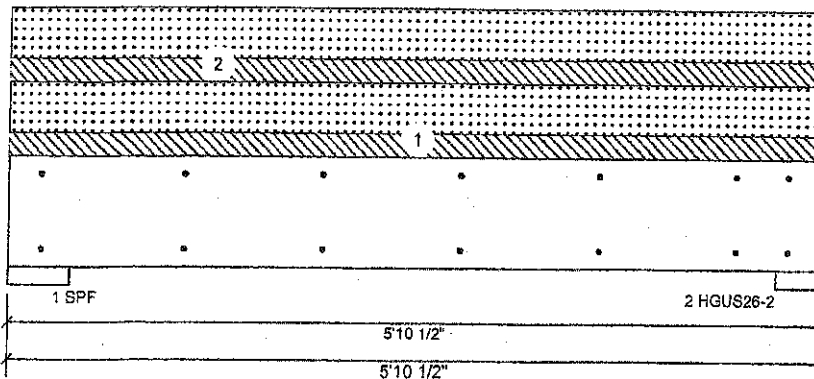

Member Information

Type:	Girder	Application:	Roof (Residential)
Piles:	2	Slope:	0/12
Moisture Condition:	Dry	Design Method:	LSD
Deflection LL:	360	Building Code:	NBCC 2015 / OBC 2012
Deflection TL:	360	Load Sharing:	No
Importance:	Normal	Deck:	Not Checked
		Vibration:	Not Checked

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Live	Dead	Snow	Wind
1	0	278	602	0
2	0	266	577	0

Bearings and Factored Reactions


Bearing	Length	Cap. React D/L lb	Total Ld. Case	Ld. Comb.
1 - SPF	5.500"	12%	348 / 903	1250 L
2 - HGUS...	4.000"	16%	333 / 855	1198 L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	1413 ft-lb	3'	6039 ft-lb	0.234 (23%)	1.25D+1.5S	L
Unbraced	1413 ft-lb	3'	5236 ft-lb	0.270 (27%)	1.25D+1.5S	L
Shear	1085 lb	12"	3984 lb	0.272 (27%)	1.25D+1.5S	L
LL Defl inch	0.012 (L/5129)	3'	0.174 (L/360)	0.070 (7%)	S	L
TL Defl inch	0.018 (L/3508)	3'	0.174 (L/360)	0.100 (10%)	D+S	L


Design Notes

- 1 Fasten all plies using 2 rows of Pneumatic Gun Nail (.120x3.25") at 12" o.c. Maximum end distance not to exceed 6".
- 2 Refer to last page of calculations for fasteners required for specified loads.
- 3 Girders are designed to be supported on the bottom edge only.
- 4 Top braced at bearings.
- 5 Bottom braced at bearings.
- 6 Lateral slenderness ratio based on single ply width.

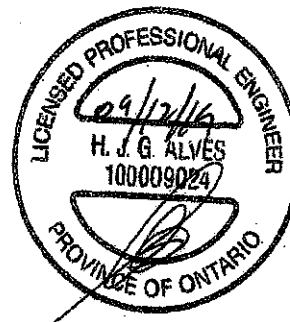

DWG NO. TAM 119235 64
STRUCTURAL
COMPONENT ONLY 1/2

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Uniform		1-0-0	Far Face	13.4 PSF	0 PSF	29 PSF	0 PSF	
2	Uniform		5-11-0	Near Face	13.4 PSF	0 PSF	29 PSF	0 PSF	

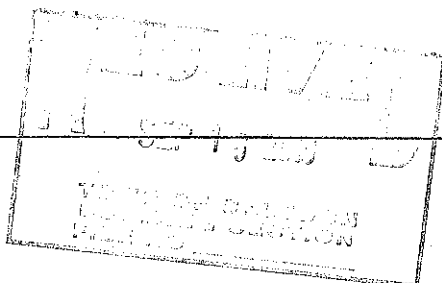

Manufacturer Info

Tamarack Roof Trusses
3255 North Service Road, ON
L7N 3G2
905-335-1115



This design is valid until 12/11/2021





isDesign™



Client:
Project:
Address:

Date: 2/2019
Designer:
Job Name: 405481
Project #:

Page 2 of 4

B1 S-P-F #2 2.000" X 10.000" 2-Ply - PASSED


Level: Level

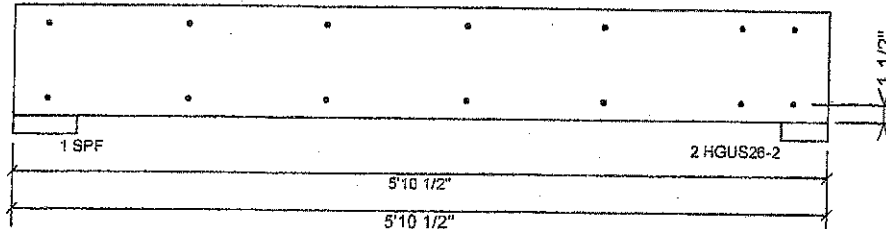


Multi-Ply Analysis

Fasten all plies using 2 rows of Pneumatic Gun Nail (.120x3.25") at 12" o.c. Maximum end distance not to exceed 6"

Capacity	78.6 %
Load	178.2 PLF
Yield Limit per Foot	226.7 PLF
Yield Limit per Fastener	113.3 lb.
Yield Mode	9
Edge Distance	1 1/2"
Min. End Distance	3"
Load Combination	1.25D+1.5S
Duration Factor	1.00

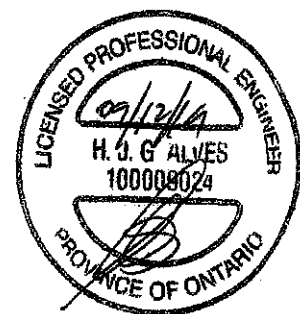

DWG NO. TAM **P923564**
STRUCTURAL
COMPONENT ONLY **3/2**

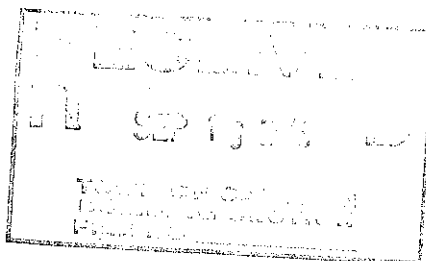

This design is valid until 12/11/2021

Manufacturer Info	Tamarack Roof Trusses 3255 North Service Road, ON L7N 3G2 905-335-1115
	TAMARACK LUMBER INC. ALFA LUMBER GROUP





isDesign™



Client:
Project:
Address:

Date: 7/2019
Designer:
Job Name: 405481
Project #:

Page 3 of 4

B2 S-P-F #2 2.000" X 10.000" 2-Ply - PASSED

Level: Level

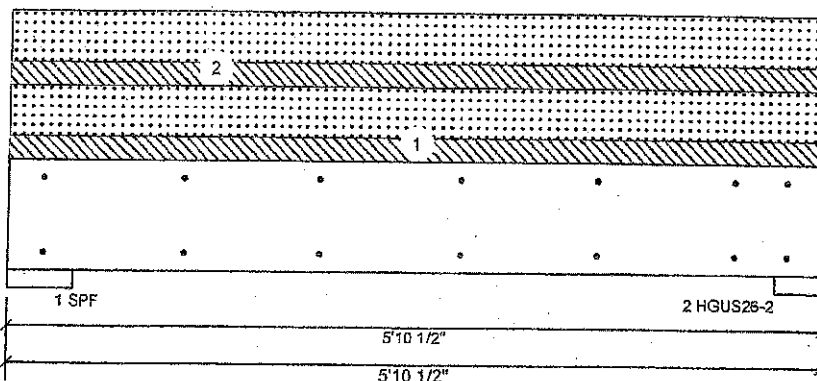

Member Information

Type: Girder
Plies: 2
Moisture Condition: Dry
Deflection LL: 360
Deflection TL: 360
Importance: Normal

Application: Roof (Residential)
Slope: 0/12
Design Method: LSD
Building Code: NBCC 2015 / OBC 2012
Load Sharing: No
Deck: Not Checked
Vibration: Not Checked

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Live	Dead	Snow	Wind
1	0	274	593	0
2	0	262	568	0

Bearings and Factored Reactions


Bearing	Length	Cap. React D/L lb	Total Ld. Case	Ld. Comb.
1 - SPF	5.500"	12%	342 / 889	1231 L 1.25D+1.5S
2 - HGUS...	4.000"	18%	328 / 852	1180 L 1.25D+1.5S

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	1392 ft-lb	3'	6039 ft-lb	0.230 (23%)	1.25D+1.5S	L
Unbraced	1392 ft-lb	3'	5236 ft-lb	0.266 (27%)	1.25D+1.5S	L
Shear	1069 lb	4'10"	3984 lb	0.268 (27%)	1.25D+1.5S	L
LL Defl inch	0.012 (L/5208)	3'	0.174 (L/360)	0.070 (7%)	S	L
TL Defl inch	0.018 (L/3562)	3'	0.174 (L/360)	0.100 (10%)	D+S	L


Design Notes

- 1 Fasten all plies using 2 rows of Pneumatic Gun Nail (.120x3.25") at 12" o.c. Maximum end distance not to exceed 6".
- 2 Refer to last page of calculations for fasteners required for specified loads.
- 3 Girders are designed to be supported on the bottom edge only.
- 4 Top braced at bearings.
- 5 Bottom braced at bearings.
- 6 Lateral slenderness ratio based on single ply width.

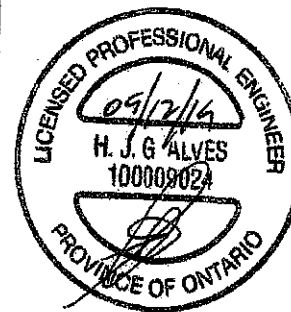

DWG NO. TAM 7723563
STRUCTURAL
COMPONENT ONLY 1/2

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Uniform		1-0-0	Far Face	13.4 PSF	0 PSF	29 PSF	0 PSF	
2	Uniform		5-9-12	Near Face	13.4 PSF	0 PSF	29 PSF	0 PSF	

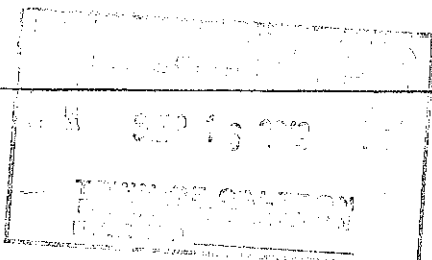

This design is valid until 12/11/2021

Manufacturer Info

Tamarack Roof Trusses
3255 North Service Road, ON
L7N 3G2
905-335-1115





isDesign™



Client:
Project:
Address:

Date: 2/20/19
Designer:
Job Name: 405481
Project #:

Page 4 of 4

B2 S-P-F #2 2.000" X 10.000" 2-Ply - PASSED



Level: Level

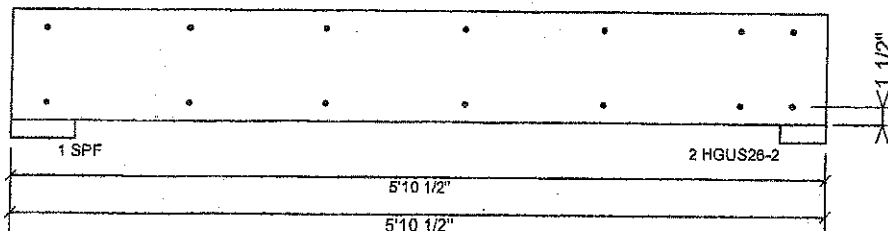

Multi-Ply Analysis

Fasten all plies using 2 rows of Pneumatic Gun Nail (.120x3.25") at 12" o.c. Maximum end distance not to exceed 6".

Capacity	77.2 %
Load	175.1 PLF
Yield Limit per Foot	226.7 PLF
Yield Limit per Fastener	113.3 lb.
Yield Mode	9
Edge Distance	1 1/2"
Min. End Distance	3"
Load Combination	1.25D+1.5S
Duration Factor	1.00

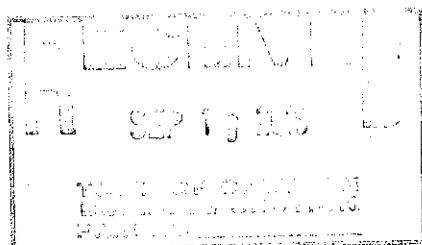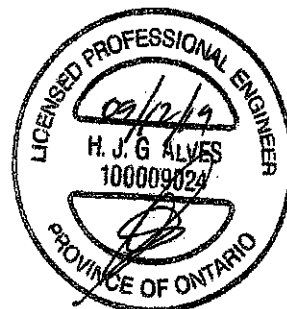

DWG NO. TAM T1923563
STRUCTURAL
COMPONENT ONLY 3/2

Manufacturer Info

Tamarack Roof Trusses
3255 North Service Road, ON
L7N 3G2
905-335-1115



This design is valid until 12/11/2021

LUL/LUS/LJS/HUS/HHUS/HGUS



Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258-259.


Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20-24.

Installation:

- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:

- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.

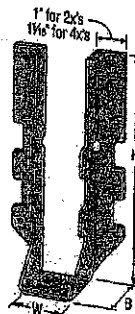


LUS28




LU26L



HUS210
(HUS26, HUS28,
and HHUS similar)




HGUS28-2




HHUS210-2



Double-Shear
Nailing
Top View





Double-Shear
Nailing
Side View;
Do not
bend tab



Dome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,580

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

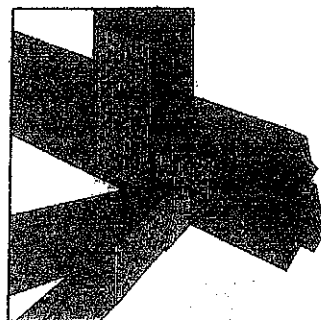

LJS26DS

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options Information on pp. 125-127.



HHUS -- Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS -- Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value



Top View HHUS Hanger
Skewed Right
(joist must be bevel cut)
All joist nails installed on the
outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance					
		W	H	B	d _e ³	Header	Joist	S-P-F		Uplift (K ₆ = 1.00)	Normal (K ₆ = 1.00)		
								lb.	lb.				
												lb.	lb.
Single 2x Sizes													
LUS24	18	1 1/8	3 1/4	1 3/4	2 1/4	(4) 10d	(2) 10d	710	1625	645	1155		
								310	720	287	514		
LU24L	22	1 1/8	3	1 1/4	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360	1020	320	725		
								160	460	142	322		
LU28L	22	1 1/8	5	1 3/4	4 1/4	(6) 10d	(4) 10d x 1 1/2"	720	1805	645	1140		
								320	805	287	507		
LUS26	18	1 1/8	4 1/4	1 3/4	3 3/4	(4) 10d	(4) 10d	1420	2170	1290	1630		
								630	930	574	725		
HUS26	16	1 1/8	5 1/4	3	3 1/8	(14) 16d	(6) 16d	2705	4940	2065	3875		
								1230	2290	920	1724		
LJS26DS	18	1 1/8	5	3 1/2	4 1/4	(16) 16d	(6) 16d	2055	4265	1460	4115		
								920	1915	645	1831		
HGUS26	12	1 1/8	5 3/4	5	4 1/4	(20) 16d	(8) 16d	2635	6625	2685	5700		
								1185	3035	1196	2535		
LU28L	20	1 1/8	6 3/4	1 3/4	5 1/4	(8) 10d	(6) 10d x 1 1/2"	1140	2185	1020	1550		
								510	995	454	689		
LUS28	18	1 1/8	6 1/4	1 3/4	3 3/4	(6) 10d	(4) 10d	1420	2520	1290	1790		
								640	1100	574	796		
HUS28	16	1 1/8	7 1/4	3	6 1/8	(22) 16d	(8) 16d	3605	5365	2675	4345		
								1605	2365	1190	1933		
HGUS28	12	1 1/8	7 1/4	5	6 1/4	(36) 16d	(12) 16d	3310	7675	3310	6900		
								1474	3310	1474	3073		
LU210L	20	1 1/8	8	1 3/4	7 1/4	(10) 10d	(6) 10d x 1 1/2"	1140	2495	1020	1770		
								510	1120	454	787		
LUS210	18	1 1/8	7 1/4	1 3/4	3 3/4	(8) 10d	(4) 10d	1420	2785	1290	2210		
								630	1235	574	983		


1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_e is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27-28 for other nail sizes and information.

Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)					Fasteners		Factored Resistance			
		W	H	B	d _a ^a	Header	Joist	D-F-T ^b		S-P-F		
								Uplift (K _D = 1.15) lb. kN	Normal (K _D = 1.00) lb. kN	Uplift (K _D = 1.15) lb. kN	Normal (K _D = 1.00) lb. kN	
Double 2x Sizes												
LUS24-2	18	3 3/4	3 3/4	2	1 1/4	(4) 16d	(2) 16d	835	2020	590	1435	
								721	1782	262	638	
LUS26-2	18	3 3/4	4 1/4	2	4	(4) 16d	(4) 16d	1720	2595	1545	1920	
								1463	2145	687	854	
HHUS26-2	14	3 3/4	5 3/4	3	3 3/4	(14) 16d	(6) 16d	2650	7335	2065	5205	
								2168	5793	920	2315	
HGUS26-2	12	3 3/4	5 3/4	4	4 1/4	(20) 16d	(8) 16d	4385	8950	3110	6355	
								3634	7363	1383	2827	
LUS28-2	18	3 3/4	7	2	4	(6) 16d	(4) 16d	1720	3325	1545	2575	
								1463	3124	687	1145	
HHUS28-2	14	3 3/4	7 1/4	3	6 1/4	(22) 16d	(8) 16d	3765	8940	2675	6345	
								3165	7333	1190	2822	
HGUS28-2	12	3 3/4	7 1/4	4	6 1/4	(36) 16d	(12) 16d	6070	12980	4310	9215	
								5000	10777	1917	4099	
LUS210-2	18	3 3/4	9	2	6	(8) 16d	(6) 16d	2580	4500	2320	3195	
								2168	3702	1032	1421	
HHUS210-2	14	3 3/4	9 1/4	3	8	(30) 16d	(10) 16d	4670	9660	4235	7000	
								3897	7727	1884	3174	
HGUS210-2	12	3 3/4	9 1/4	4	8 1/4	(48) 16d	(16) 16d	8840	14015	4855	10270	
								7304	11714	2160	4569	
Triple 2x Sizes												
HGUS26-3	12	4 1/4	5 1/4	4	4 1/4	(20) 16d	(8) 16d	4385	8950	3110	6355	
								3634	7363	1383	2827	
HGUS28-3	12	4 1/4	7 1/4	4	6 1/4	(36) 16d	(12) 16d	6070	12980	4310	9215	
								5000	10777	1917	4099	
HHUS210-3	14	4 1/4	9	3	7 1/4	(30) 16d	(10) 16d	4670	9670	4235	6865	
								3897	7730	1884	3054	
HGUS210-3	12	4 1/4	9 1/4	4	8 1/4	(48) 16d	(16) 16d	8840	14645	4855	10400	
								7304	12107	2160	4626	
Quadruple 2x Sizes												
HGUS26-4	12	6 3/4	5 3/4	4	4 1/4	(20) 16d	(8) 16d	4385	8950	3110	6355	
								3634	7363	1383	2827	
HGUS28-4	12	6 3/4	7 3/4	4	6 1/4	(36) 16d	(12) 16d	6070	12980	4310	9215	
								5000	10777	1917	4099	
HHUS210-4	14	6 3/4	8 3/4	3	7 1/4	(30) 16d	(10) 16d	4670	10155	4235	7210	
								3897	8123	1884	3207	
HGUS210-4	12	6 3/4	9 3/4	4	8 1/4	(48) 16d	(16) 16d	8840	14645	4855	10400	
								7304	12107	2160	4626	
HGUS212-4	12	6 3/4	10 3/4	4	10 1/4	(56) 16d	(20) 16d	7640	14995	5425	10645	
								6348	12722	2413	4235	
HGUS214-4	12	6 3/4	12 3/4	4	11 1/4	(66) 16d	(22) 16d	10130	16400	7195	11645	
								8366	17195	3200	5180	
4x Sizes												
LUS46	18	3 3/4	4 1/4	2	3 3/4	(4) 16d	(4) 16d	1720	2595	1545	1920	
								1463	2145	687	854	
HHUS46	14	3 3/4	5 1/4	3	3 3/4	(14) 16d	(6) 16d	2540	7335	2065	5205	
								2120	5793	920	2315	
HGUS46	12	3 3/4	5 1/4	4	4 1/4	(20) 16d	(8) 16d	4385	8950	3110	6355	
								3634	7363	1383	2827	
LUS48	18	3 3/4	6 1/4	2	3 3/4	(6) 16d	(4) 16d	1720	3325	1545	2575	
								1463	3124	687	1145	
HHUS48	14	3 3/4	7 1/4	3	6 1/4	(22) 16d	(8) 16d	3765	8940	2675	6345	
								3165	7333	1190	2822	
HGUS48	12	3 3/4	7 1/4	4	6 1/4	(36) 16d	(12) 16d	6070	12980	4310	9215	
								5000	10777	1917	4099	
LUS410	18	3 3/4	8 1/4	2	5 3/4	(8) 16d	(6) 16d	2580	4500	2320	3195	
								2168	3702	1032	1421	
HGUS410	12	3 3/4	9	4	8 1/4	(48) 16d	(16) 16d	8840	14015	4855	10270	
								7304	11714	2160	4569	
HGUS412	12	3 3/4	10 1/4	4	10 1/4	(56) 16d	(20) 16d	7640	14995	5425	10645	
								6348	12722	2413	4735	
HGUS414	12	3 3/4	12 1/4	4	11 1/4	(66) 16d	(22) 16d	10130	16400	7195	11645	
								8366	17298	3200	5180	




Plated Truss Connectors


See footnotes
on p. 258.

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/4\" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.

Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

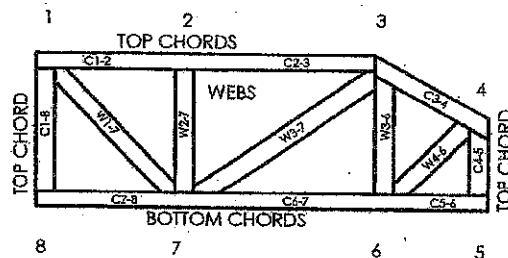

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved


MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MII-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1900219

Feb 09, 2018