


URBAN 1
FRONT ELEV.-2
UNIT 89-4, 91-3 & 93-4
LOWES HILL CIRCLE
405544

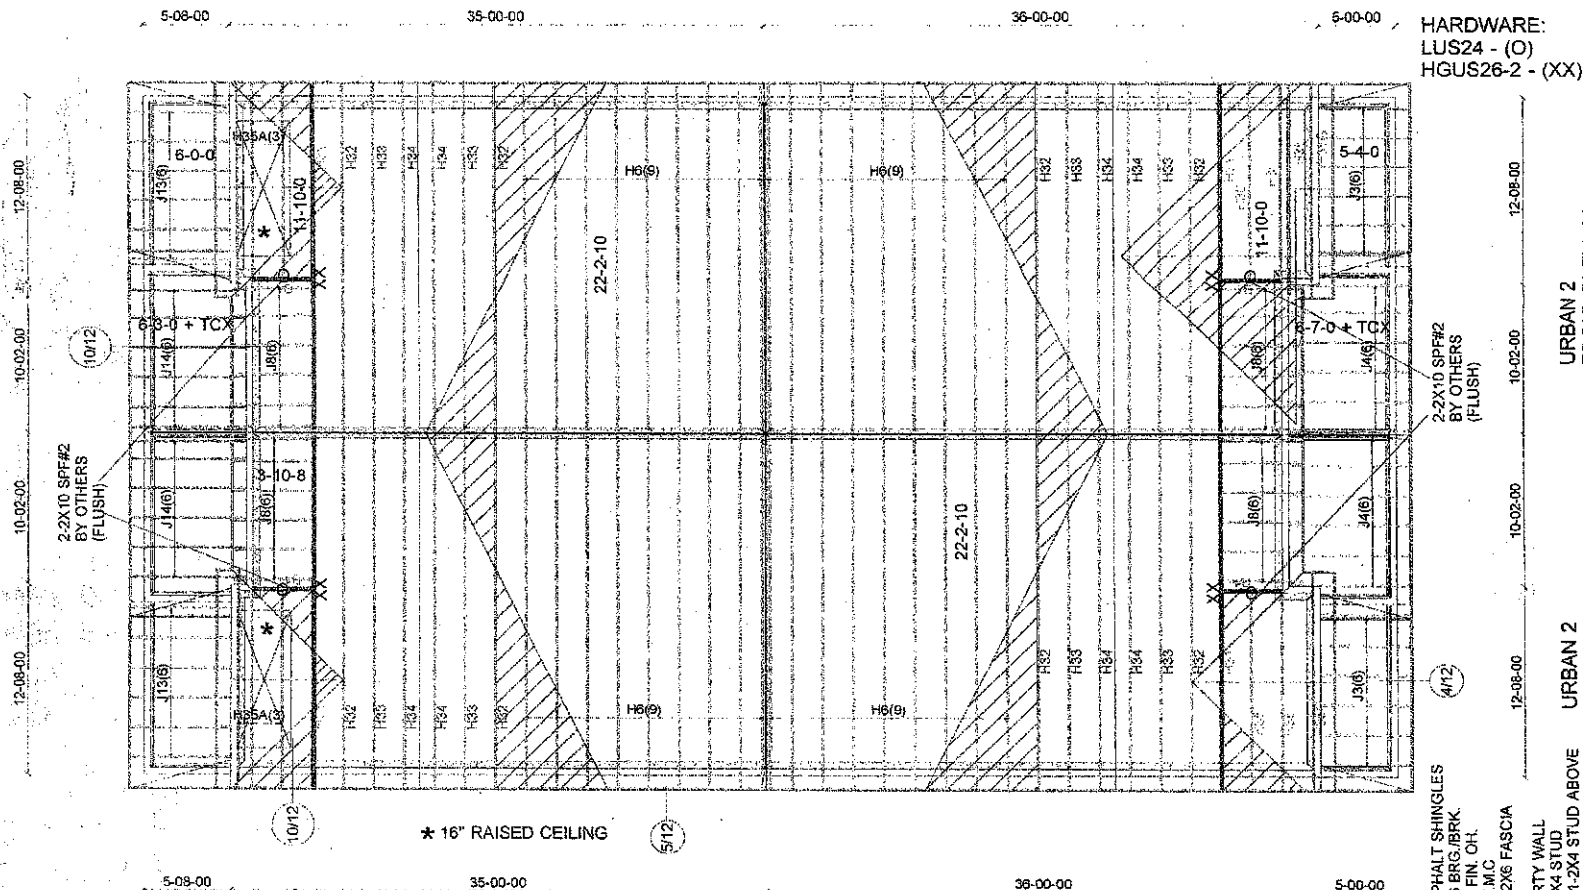

URBAN 2
FRONT ELEV.-2A
UNIT 89-2, 91-2 & 93-2
DEER RIDGE TRAIL
405546

URBAN 2
FRONT ELEV.-2
UNIT 89-1, 91-1 & 93-1
DEER RIDGE TRAIL
405545

M12633



Job Track: **50033**
Plan Log: **201724**
Layout ID: **405543**

Builder / Location:
GREEN PARK HOMES / CALEDON

Project: **LAMBERT LANE PH.2**


Date: **9/10/2019** Sales: **Mario DiCano** Designer: **AC**

Model / Elevation: **BLOCK 89, 91, 93 / 89-1 - 89-4,
91-1 - 91-4, 93-1 - 93-4**

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

 TAMARACK ROOF TRUSSES INC. ALFA LUMBER GROUP		DELIVERY SHIPLIST	
		Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: LAMBERT LANE PH.2 Location: CALEDON Model: BLOCK 89, 91, 93 Lot #: Elevation: UNITS 89-3, 89-4, 91-3, 91-4, 93-3,	Job Track: 50033 PlanLog: 201724 Layout ID: 405544 Ref # Page: 1 of 1 Date: 09/10/2019 Designer: Andrew Conway Sales Rep: Mario DiCano

Roof Trusses


PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	9	H6 Monopitch	5/12	22-02-10	10-03-10	2 x 4	1-03-08	1-00-09 10-03-10	860.46 535.50		
	1 2-ply	H31 Flat Girder	0/12	22-02-10	4-10-07	2 x 4 2 x 6	1-03-08	4-10-07 4-10-07	226.57 143.33		
	2	H32 Flat	0/12	22-02-10	6-06-07	2 x 4	1-03-08	6-06-07 6-06-07	196.02 120.67		
	2	H33 Flat	0/12	22-02-10	8-02-07	2 x 4	1-03-08	8-02-07 8-02-07	235 144.00		
	2	H34 Flat	0/12	22-02-10	9-10-07	2 x 4	1-03-08	9-10-07 9-10-07	256.77 157.33		
	3	H35A Roof Special Structural Gable	10/12	11-10-00	6-06-14	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	170.58 116.50		
	6	J8 Jack-Open	10/12	3-10-08	4-10-07	2 x 4	1-03-08	1-07-11 4-10-07	82.48 52.00		
	6	J13 Jack-Open	4/12	6-00-00	2-08-14	2 x 4	1-03-08	7-15 2-04-15	98.04 64.00		
	6	J14 Jack-Partial	4/12	6-03-00	3-00-14	2 x 4	1-03-08	7-15 2-08-15	166.79 119.00		


TOTAL # TRUSS= 38 TOTAL BFT OF ALL TRUSSES= 1452.33 BFT. TOTAL WEIGHT OF ALL TRSSES 2292.71 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	LUS24	
1	Hardware	HGUS26-2	

TOTAL NUMBER OF
ITEMS= 2

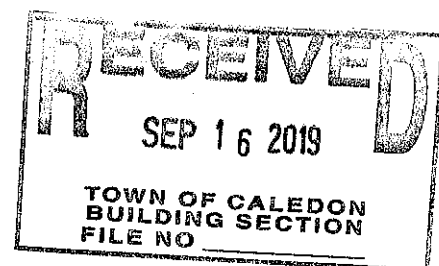

 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER	Job Track: 50033
	Builder: GREEN PARK HOMES	PlanLog: 201724
	Project: LAMBERT LANE PH.2	Layout ID: 405545
	Location: CALEDON	Ref #: 1 of 1
	Model: BLOCK 89, 91, 93	Date: 09/10/2019
Lot #: 89-1, 91-1, 93-1	Designer: Andrew Conway	
Elevation: UNITS 89-1, 91-1, 93-1	Sales Rep: Mario DiCano	

Roof Trusses


PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	9	H6 Monopitch	5/12	22-02-10	10-03-10	2 x 4	1-03-08	1-00-09 10-03-10	880.46 535.50		
	1 2-ply	H31 Flat Girder	0/12	22-02-10	4-10-07	2 x 4 2 x 6	1-03-08	4-10-07 4-10-07	226.57 143.33		
	2	H32 Flat	0/12	22-02-10	6-06-07	2 x 4	1-03-08	6-06-07 6-06-07	196.02 120.67		
	2	H33 Flat	0/12	22-02-10	8-02-07	2 x 4	1-03-08	8-02-07 8-02-07	235 144.00		
	2	H34 Flat	0/12	22-02-10	9-10-07	2 x 4	1-03-08	9-10-07 9-10-07	256.77 167.33		
	2	H35 Common	10/12	11-10-00	6-06-14	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	114.86 74.00		
	1	H35G GABLE	10/12	11-10-00	6-06-14	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	57.55 37.00		
	6	J3 Jack-Open	4/12	5-04-00	2-06-03	2 x 4	1-03-08	7-15 2-02-04	88.67 64.00		
	6	J4 Jack-Closed	4/12	6-07-00	3-02-03	2 x 4	1-03-08	7-15 2-10-04	174.3 123.00		
	6	J8 Jack-Open	10/12	3-10-08	4-10-07	2 x 4	1-03-08	1-07-11 4-10-07	82.48 52.00		

TOTAL # TRUSS= 38 TOTAL BFT OF ALL TRUSSES= 1450.83 BFT. TOTAL WEIGHT OF ALL TRSSES 2292.67 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	LUS24	
1	Hardware	HGUS26-2	

TOTAL NUMBER OF
ITEMS= 2

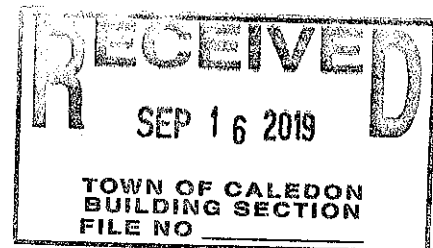

TAMARACK ROOF TRUSSES INC. ALFA LUMBER GROUP		DELIVERY SHIPLIST	
Lumber Yard:	TAMARACK LUMBER	Job Track:	50033
Builder:	GREEN PARK HOMES	PlanLog:	201724
Project:	LAMBERT LANE PH.2	Layout ID:	405546
Location:	CALEDON	Ref #	
Model:	BLOCK 89, 91, 93	Page:	1 of 1
Lot #:		Date:	09/10/2019
Elevation:	UNITS 89-2, 91-2, 93-2	Designer:	Andrew Conway
		Sales Rep:	Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	9	H6 Monopitch	5 /12	22-02-10	10-03-10	2 x 4	1-03-08	1-00-09 10-03-10	860.46 535.50		
	1 2-ply	H31 Flat Girder	0 /12	22-02-10	4-10-07	2 x 4 2 x 6	1-03-08	4-10-07 4-10-07	226.57 143.33		
	2	H32 Flat	0 /12	22-02-10	6-06-07	2 x 4	1-03-08	6-06-07 6-06-07	196.02 120.67		
	2	H33 Flat	0 /12	22-02-10	8-02-07	2 x 4	1-03-08	8-02-07 8-02-07	235 144.00		
	2	H34 Flat	0 /12	22-02-10	9-10-07	2 x 4	1-03-08	9-10-07 9-10-07	256.77 157.33		
	1	H35 Common	10 /12	11-10-00	6-06-14	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	57.43 37.00		
	1	H35G GABLE	10 /12	11-10-00	6-06-14	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	57.55 37.00		
	2	H36 Common Structural Gable	10 /12	11-10-00	10-03-14	2 x 4	1-03-08	1-07-11 9-01-11	147.48 92.67		
	6	J3 Jack-Open	4 /12	5-04-00	2-06-03	2 x 4	1-03-08	7-15 2-02-04	88.67 64.00		
	6	J4 Jack-Closed	4 /12	6-07-00	3-02-03	2 x 4	1-03-08	7-15 2-10-04	174.3 123.00		
	6	J8 Jack-Open	10 /12	3-10-08	4-10-07	2 x 4	1-03-08	1-07-11 4-10-07	82.48 52.00		

TOTAL # TRUSS= 39

TOTAL BFT OF ALL TRUSSES= 1506.5


BFT.

TOTAL WEIGHT OF ALL TRSSES 2382.72 LBS


HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	LUS24	
1	Hardware	HGUS26-2	

TOTAL NUMBER OF
ITEMS= 2

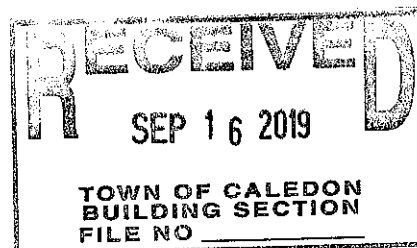

JOB NAME 405486	TRUSS NAME H6	QUANTITY 36	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

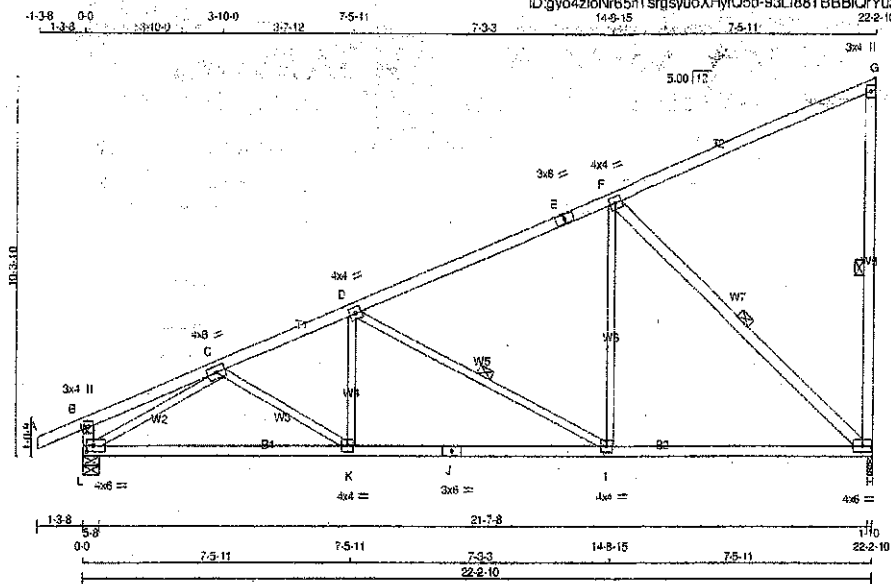

TOTAL WEIGHT = 38 X 99 = 3566 lb (M/F)

LUMBER

N. L. C. A. RULES	CHORDS	SIZE	LUMBER	DESCR
A - F	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF
L - B	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	3PF
J - H	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF

DRY, SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	GROSS REACTION	BRG	BRG
DOWN	DOWN	DOWN	UPLIFT	UPLIFT
H	1339	0	1339	0
L	1476	0	1476	0

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
H	942 844 / 0 0 / 0 0 / 0 298 / 0 0 / 0
L	1037 723 / 0 0 / 0 0 / 0 314 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS) H, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.50 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-H, D-I, F-H.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. (PLF)	MEMB.	FORCE (LBS)
FR-TO	0 / 26	-102.0 -102.0 0.13 (1)	FR-TO	0 / 139
A-B	0 / 8	-102.0 -102.0 0.20 (1)	K-D	0 / 841 / 0
B-C	-1943 / 0	-102.0 -102.0 0.34 (1)	D-I	0 / 547 / 0
C-D	-1140 / 0	-102.0 -102.0 0.69 (1)	F-H	-1454 / 0
D-E	-1140 / 0	-102.0 -102.0 0.69 (1)	C-K	0 / 55 / 0
E-F	-32 / 0	-102.0 -102.0 0.70 (1)	L-C	-2118 / 0
F-G	298 / 0	0.0 0.0 0.16 (1)		0.68 (1)
G-H	-309 / 0	0.0 0.0 0.03 (1)		
L-K	0 / 1804	-18.5 -18.5 0.42 (1)		
K-J	0 / 1812	-18.5 -18.5 0.43 (1)		
J-I	0 / 1812	-18.5 -18.5 0.43 (1)		
I-H	0 / 1089	-18.5 -18.5 0.32 (4)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.0 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.74")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/380 (0.74")
CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CSI: TC=0.70/1.00 (F-G:1), BC=0.43/1.00 (I-K:1),
WB=0.78/1.00 (F-H:1), SI=0.33/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.



NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
WT20	610	354	1667


PLATE PLACEMENT TOL = 0.250 Inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.88 (L) (INPUT = 0.90)
JSI METAL = 0.59 (J) (INPUT = 1.00)

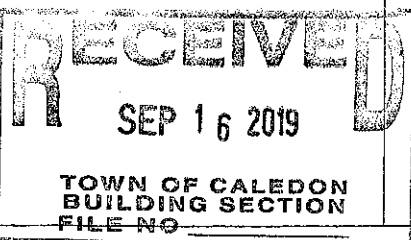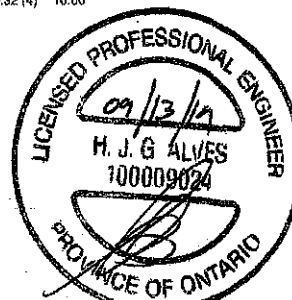

Structural component only
DWG# T-1923426

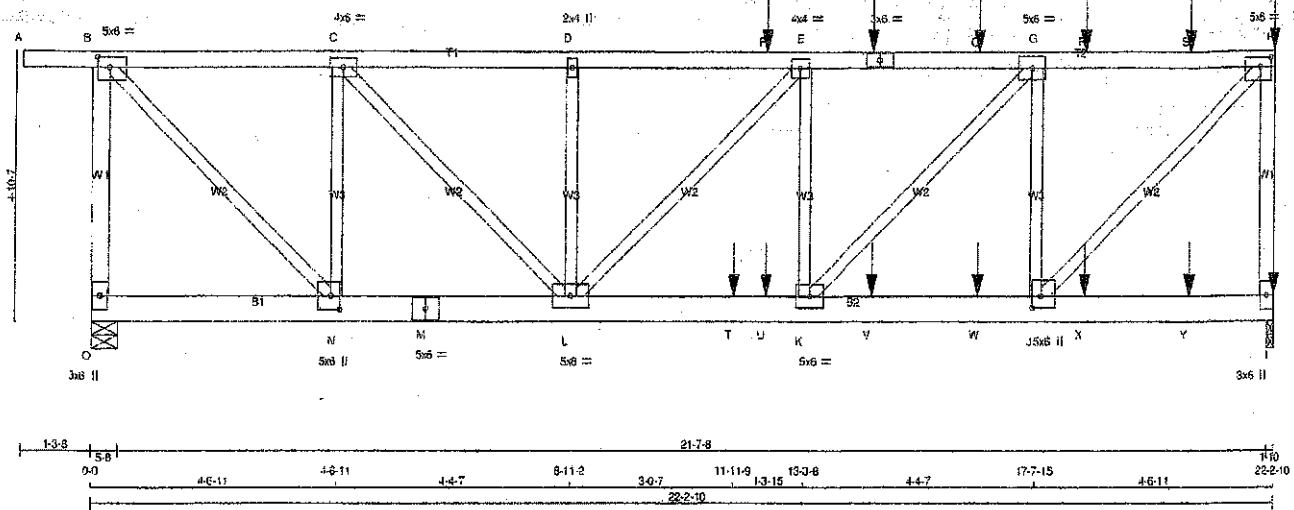[illegible]

TOTAL WEIGHT = 8 X 113 = 906 lb

LUMBER				
N. L. & A. RULES				
CHORDS	SIZE		LUMBER	DESCR.
O - B	2x4	DRY	No.2	SPF
A - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
I - H	2x4	DRY	No.2	SPF
O - M	2x6	DRY	No.2	SPF
M - I	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
 DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS	#ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122'X3") SPIRAL NAILS			
O-B	1	12	TOP
A-F	1	12	SIDE(0.0)
F-H	1	12	SIDE(81.0)
H-I	1	12	TOP
BOTTOM CHORDS : (0.122'X3") SPIRAL NAILS			
O-M	2	12	TOP
M-I	2	12	SIDE(0.0)
WEBS : (0.122'X3") SPIRAL NAILS			
2x3	1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UOL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)					
	TYPE	PLATES	W	LEN	Y X
B	TWVW-1	MT20	5.0	5.0	2.25 2.50
C	TWVW-1	MT20	4.0	5.0	
D	TWVW-w	MT20	2.0	4.0	
E	TWVW-1	MT20	4.0	4.0	
F	TS-1	MT20	3.0	5.0	
G	TWVW-1	MT20	5.0	5.0	
H	TWVW-1	MT20	5.0	6.0	2.00 2.50
I	BMV1+p	MT20	3.0	6.0	
J	BMVW-w	MT20	5.0	6.0	2.50 2.00
K	BMVW-1	MT20	5.0	6.0	
L	BMVWV-1	MT20	5.0	8.0	
M	BS-1	MT21	5.0	6.0	
N	BMVW-1	MT20	5.0	6.0	3.00 2.00
O	BMV1+p	MT20	3.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REORD
GROSS REACTION		GROSS REACTION				BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
O	1918	0	1918	0	0	5-8	5-8
I	2277	0	2277	0	0	1-10	1-10

UNFACTORED REACTIONS

1ST CASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
O	1348	944.0	0.0	0.0	0.0	402.0	0.0
I	1601	1107.0	0.0	0.0	0.0	493.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.16 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. CS (LC)	MAX. UNBRAC	MEMB.	FORCE (LBS)	MAX. CS (LC)
FR-TO		FROM TO		LENGTH	FR-TO		
C-B	-1871 / 0	0.0	0.0	0.34 (1)	7.81	J-H	0 / 2576
A-B	0 / 0	-102.0	-102.0	0.06 (1)	10.00	B-N	0 / 2210
B-C	-1573 / 0	-102.0	-102.0	0.17 (1)	6.25	J-G	-1748 / 0
C-D	-2533 / 0	-102.0	-102.0	0.19 (1)	5.49	N-C	-1504 / 0
D-P	-2539 / 0	-102.0	-102.0	0.18 (1)	5.50	K-G	0 / 1370
P-E	-2533 / 0	-102.0	-102.0	0.18 (1)	5.50	C-L	0 / 1377
E-F	-2788 / 0	-102.0	-102.0	0.28 (1)	5.16	K-E	-339 / 0
F-Q	-2788 / 0	-102.0	-102.0	0.28 (1)	5.16	L-D	-432 / 0
Q-G	-2788 / 0	-102.0	-102.0	0.28 (1)	5.16	L-E	-365 / 0
R-H	-1834 / 0	-102.0	-102.0	0.32 (1)	8.09		
R-S	-1834 / 0	-102.0	-102.0	0.32 (1)	8.09		
S-H	-1834 / 0	-102.0	-102.0	0.32 (1)	8.09		
I-H	-2189 / 0	0.0	0.0	0.40 (1)	7.52		
C-N	0 / 0	-18.5	-18.5	0.02 (4)	10.00		
N-M	0 / 1573	-18.5	-18.5	0.14 (1)	10.00		
M-L	0 / 1573	-18.5	-18.5	0.14 (1)	10.00		
L-T	0 / 2788	-18.5	-18.5	0.36 (1)	10.00		
T-U	0 / 2788	-18.5	-18.5	0.36 (1)	10.00		
U-K	0 / 2788	-18.5	-18.5	0.36 (1)	10.00		
K-V	0 / 1834	-18.5	-18.5	0.19 (1)	10.00		
V-W	0 / 1834	-18.5	-18.5	0.19 (1)	10.00		
W-J	0 / 1834	-18.5	-18.5	0.19 (1)	10.00		
J-X	0 / 0	-18.5	-18.5	0.04 (4)	10.00		
X-Y	0 / 0	-18.5	-18.5	0.04 (4)	10.00		
Y-I	0 / 0	-18.5	-18.5	0.04 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC	LGI	MAX	MAX	FACE	DIR.	TYPE	HERE	CONN
F	14-9-14	-96	-96	---	FRONT	VERT	TOTAL	---	C1
H	22-2-10	-137	-137	---	FRONT	VERT	TOTAL	---	C1
I	22-2-10	-25	-25	---	FRONT	VERT	TOTAL	---	C1
Q	12-3-14	-36	-36	---	FRONT	VERT	TOTAL	---	C1
P	16-5-14	-95	-95	---	FRONT	VERT	TOTAL	---	C1
R	18-8-14	-98	-98	---	FRONT	VERT	TOTAL	---	C1
S	20-5-14	-93	-93	---	FRONT	VERT	TOTAL	---	C1
T	11-11-9	-650	-650	---	FRONT	VERT	TOTAL	---	C1
U	12-3-14	-17	-17	---	FRONT	VERT	TOTAL	---	C1
V	14-3-14	-17	-17	---	FRONT	VERT	TOTAL	---	C1
W	18-3-14	-17	-17	---	FRONT	VERT	TOTAL	---	C1
X	18-5-14	-17	-17	---	FRONT	VERT	TOTAL	---	C1
Y	20-5-14	-17	-17	---	FRONT	VERT	TOTAL	---	C1

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	=	29.0 PSF
	DL	=	6.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.4 PSF
TOTAL LOAD		=	42.4 PSF

SPACING 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018 , OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.74")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.06")
ALLOWABLE DEFL.(TL) = $L/360$ (0.74")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.10")

CSI: TC=0.40/1.00 (H-I:1), BC=0.36/1.00 (K-L:1),
WB=0.32/1.00 (H-J:1), SS=0.18/1.00 (K-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PLI)		(PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	318	354	1867	788	1987 1056

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.48 (J) (INPUT = 0.90)
JSI METAL= 0.32 (J) (INPUT = 1.00)

Structural component only
DWG# T-1923427

JOB NAME 405486	TRUSS NAME H32	QUANTITY 8	FLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.300 S May 10 2019 Mitek Industries, Inc. Fri Sep 13 10:42:49 2019, Page 1
 ID:gyo4zioNr65nt srgsyuoXHYIQ5b-5ST2ZqVRip784sARyRTteQWx7IIQA7IQmI4yFye4gK
 22-2-10

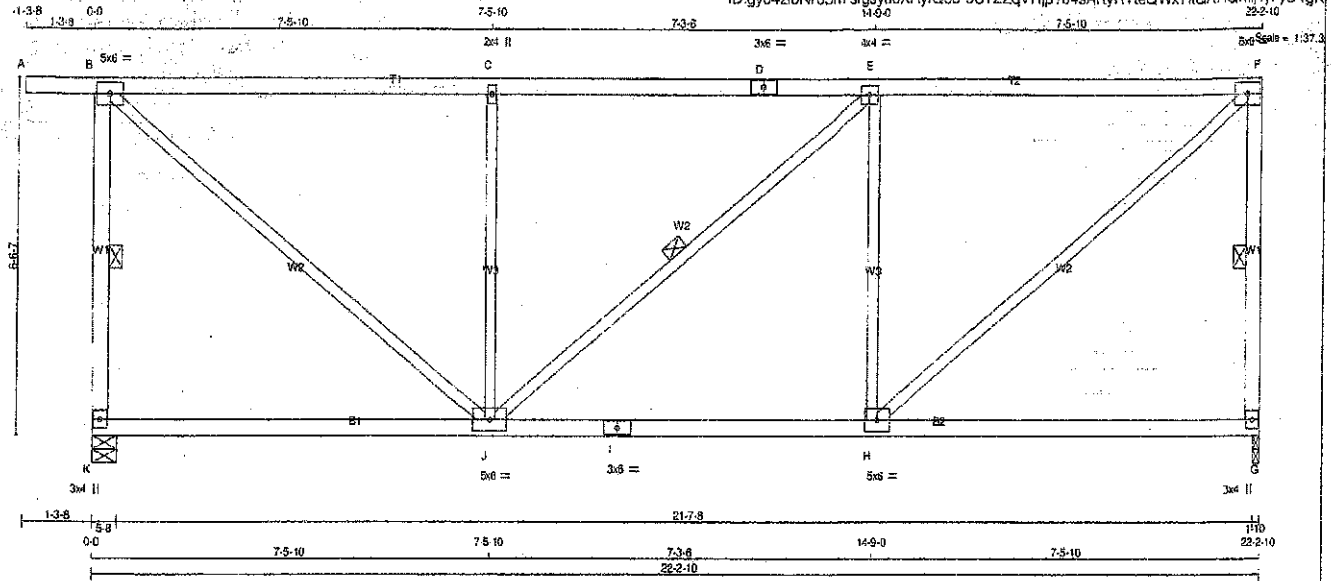

TOTAL WEIGHT = 8 X 98 = 784 lb

LUMBER			
N.L.G.A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
K - B	2x4	DRY	No.2
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
G - F	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY, SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HCRZ	GROSS REACTION	HCRZ	BRG	IN-SX	BRG	IN-SX
K	1471	0	1471	0	0	5-8	5-8		
G	1339	0	1339	0	0	1-10	1-10		

UNFACTORED REACTIONS		1ST CASE		MAX/MIN, COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
K	1033	719 / 0	0 / 0	0 / 0	313 / 0
G	942	644 / 0	0 / 0	0 / 0	296 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, G

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.30 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF B-K, F-G, E-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
 TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX
FR-TO				FR-TO			
K-B	-1414 / 0	0.0	0.0 0.28 (1)	H-F	0 / 1520	0.34 (1)	0.34 (1)
A-B	0 / 0	-102.0	-102.0 0.12 (1)	B-J	0 / 1518	0.34 (1)	0.34 (1)
B-C	-1165 / 0	-102.0	-102.0 0.88 (1)	H-E	-825 / 0	0.58 (1)	0.58 (1)
C-D	-1165 / 0	-102.0	-102.0 0.88 (1)	J-C	-825 / 0	0.58 (1)	0.58 (1)
D-E	-1165 / 0	-102.0	-102.0 0.88 (1)	E-J	-2 / 0	0.00 (1)	0.00 (1)
E-F	-1165 / 0	-102.0	-102.0 0.88 (1)				
G-F	-1282 / 0	0.0	0.0 0.25 (1)				
K-J	0 / 0	-18.5	-18.5 0.23 (4)				
J-I	0 / 1165	-18.5	-18.5 0.32 (4)				
I-H	0 / 1165	-18.5	-18.5 0.32 (4)				
H-G	0 / 0	-18.5	-18.5 0.23 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 28.0 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, CBC 2012
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55% OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.74")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
 ALLOWABLE DEFL.(TL) = L/360 (0.74")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CSI: TC=0.89/1.00 (E-F), BC=0.32/1.00 (H-I), WB=0.58/1.00 (E-H), SS=0.35/1.00 (E-F)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00



TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 789 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.80 (I) (INPUT = 0.90)
 JSI METAL = 0.39 (I) (INPUT = 1.00)

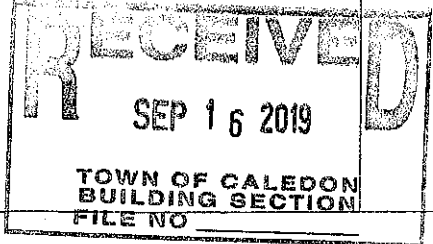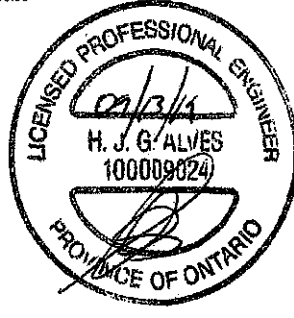


Structural component only
 DWG# T-1923428

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
405486	H33	8	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.300 5 May 10 2019 MTEK Industries, Inc. Fri Sep 13 10:42:50 2019 Page 1

ID: gyo4zlcNf65nTsgsvuoXHy/Q5b-Ze1RnAW3U6770ldW8_6De360sEvePa?PTdUlye4gJ

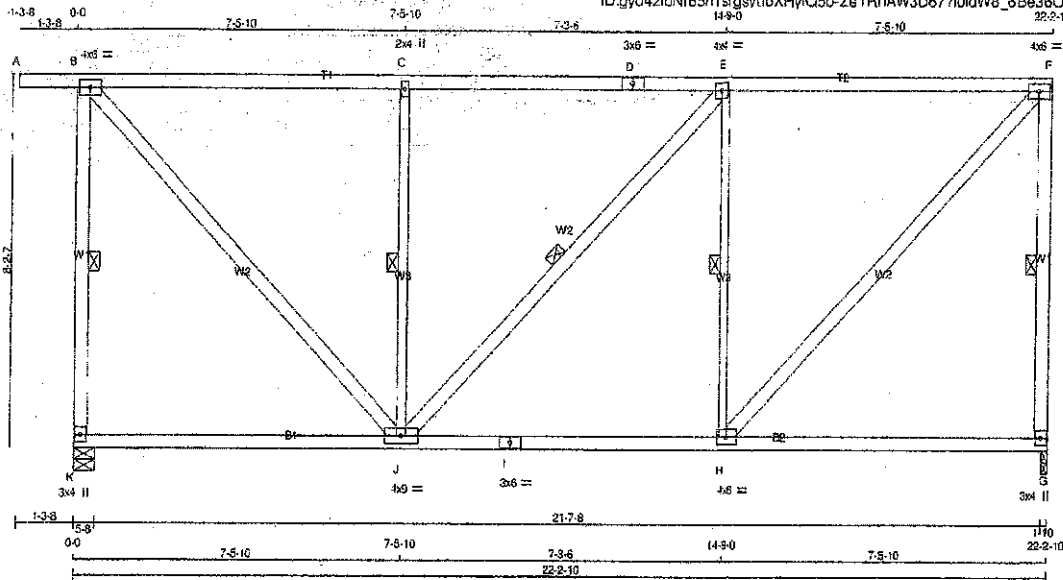

TOTAL WEIGHT = 8 X 118 = 940 lb

LUMBER

N.L.G.A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
K - B	2x4	DRY	No.2
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
G - F	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2
ALL WEBS EXCEPT	2x4	DRY	No.2
H - E	2x3	DRY	No.2
J - C	2x3	DRY	No.2

DRY, SEASONED LUMBER.

PLATES (tab/s in inches)

JT TYPE	PLATES	W	LEN	V	X
B	TMVW-1	MT20	4.0	6.0	
C	TMVW-1	MT20	2.0	4.0	
D	TS-1	MT20	3.0	6.0	
E	TMVW-1	MT20	4.0	6.0	
F	TMVW-1	MT20	4.0	6.0	
G	BMV1-p	MT20	3.0	4.0	
H	BMVW-1	MT20	4.0	6.0	
I	BS-1	MT20	3.0	6.0	
J	BMVW-1	MT20	4.0	6.0	
K	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	BRG	IN-SX	IN-SX
K	1471	0	1471	0	0	5-8	5-8		
G	1339	0	1339	0	0	1-10	1-10		

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
K	1033	719.0	0.0	0.0	0.0	313.0	0.0
G	942	844.0	0.0	0.0	0.0	298.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.74 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF B-K, F-G, E-H, C-J, E-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (LBS)	MEMB.	FORCE (LBS)	MAX. (LBS)	CSJ (LBS)
FR-TO		FROM	TO	FR-TO			
K-B	-1414.0	0.0	0.0 0.43 (1)	H-F	0.1342	0.22 (1)	
A-B	0.0	-102.0	-102.0 0.12 (1)	B-J	0.1340	0.22 (1)	
B-C	-920.0	-102.0	-102.0 0.85 (1)	H-E	-828.0	0.35 (1)	
C-D	-920.0	-102.0	-102.0 0.85 (1)	J-C	-825.0	0.35 (1)	
D-E	-920.0	-102.0	-102.0 0.85 (1)	J-E	-2.0	0.00 (1)	
E-F	-921.0	-102.0	-102.0 0.85 (1)				
G-F	-1283.0	0.0	0.0 0.39 (1)				
K-J	0.0	-18.5	-18.5 0.23 (4)				
J-I	0.921	-18.5	-18.5 0.30 (4)				
I-H	0.921	-18.5	-18.5 0.30 (4)				
H-G	0.0	-18.5	-18.5 0.23 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 0.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.74")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL) = L/360 (0.74")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSJ: TC=0.85/1.00 (E-F:1), BC=0.30/1.00 (H-J:4),
WB=0.35/1.00 (E-H:1), SS=0.38/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.82 (H) (INPUT = 0.90)
JSI METAL = 0.31 (F) (INPUT = 1.00)

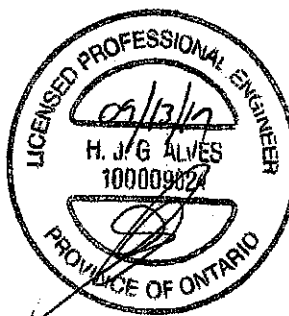


Structural component only
DWG# T-1923429

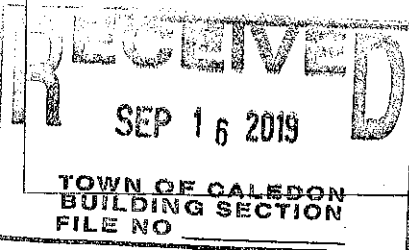

JOB NAME: 405486 TRUSS NAME: H34 QUANTITY: 8 PLV: 1 JOB DESC: GREEN PARK HOMES DRWG NO. TRUSS DESC:

Ternack Roof Truss, Burlington

Version 8.300 5 May 10 2019 Mitek Industries, Inc. Fri Sep 13 10:42:51 2019 Page 1
ID:gyo4zloNrg5nTsrqsyuoXHyfQ5b-1qbp_WWfQF5J9Kq4sVLjrbHTVaKe2gE3CA08ye4gI
23-2-10 Scale = 1:53.3

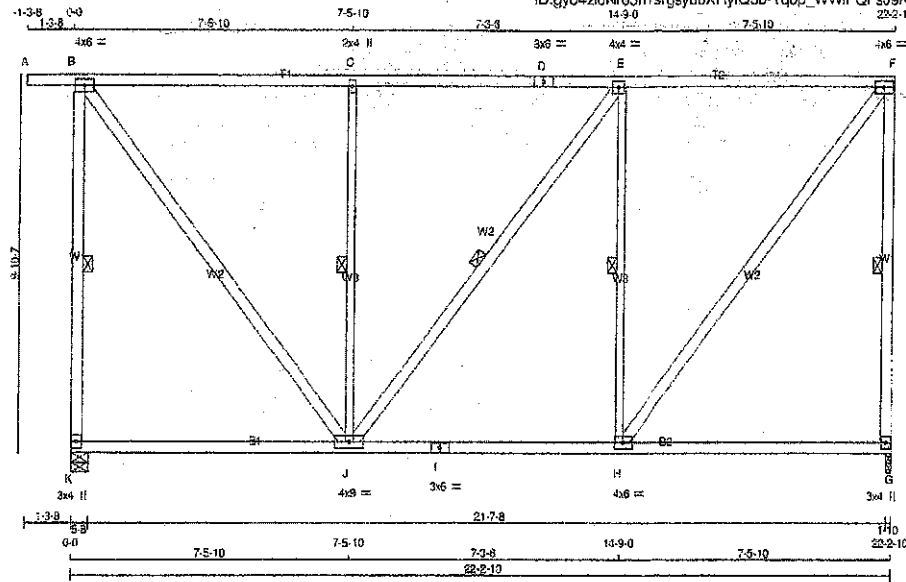

TOTAL WEIGHT = 8 X 128 = 1027 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR
K - B	2x4	DRY	No.2	SPF	
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
I - G	2x4	DRY	No.2	SPF	

ALL WEBS	2x4	DRY	No.2	SPF
EXCEPT				
H - E	2x3	DRY	No.2	SPF
J - C	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-I	MT20	4.0	6.0			
C	TMVW-I	MT20	2.0	4.0			
D	TS-I	MT20	3.0	6.0			
E	TMVW-I	MT20	4.0	4.0			
F	TMVW-I	MT20	4.0	6.0			
G	BMV1-p	MT20	3.0	4.0			
H	BMVW-I	MT20	4.0	6.0			
I	BS-I	MT20	3.0	6.0			
J	BMVW-I	MT20	4.0	9.0			
K	BMV1-p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REORD
GROSS REACTION	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORZ	UPLIFT
K	1471	0	1471	0
G	1339	0	1339	0

UNFACTORED REACTIONS	1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
K	1033	719 / 0	0 / 0
G	942	844 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.13 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED

1 LATERAL BRACE(S) AT 1/2 LENGTH OF B-K, F-G, E-H, C-J, E-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MEMB.	FORCE (LBS)
FR-TO	FROM	TO	FR-TO	FROM
K-B	-1414 / 0	0.0	H-F	0 / 1238
A-B	0 / 0	-102.0	B-J	0 / 1236
B-C	-780 / 0	-102.0	H-E	-828 / 0
C-D	-780 / 0	-102.0	J-C	-825 / 0
D-E	-780 / 0	-102.0	J-E	-2 / 0
E-F	-781 / 0	-102.0		
G-F	-1283 / 0	0.0		
K-J	0 / 0	-18.5		
J-I	0 / 781	-18.5		
I-H	0 / 781	-18.5		
H-G	0 / 0	-18.5		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 28.0 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

-PART 9 OF NBC 2010, NBC 2012

-CSA 086-09, CSA 086-14

-TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.74")

CALCULATED VERT. DEFL.(LL) = L/999 (0.04")

ALLOWABLE DEFL.(TL) = L/360 (0.74")

CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TC=0.83/1.00 (E-F), BC=0.20/1.00 (H-J), WB=0.54/1.00 (E-H), SI=0.36/1.00 (E-F)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PU)

MAX MIN MAX MIN MAX MIN


MT20 618 354 1667 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.81 (F) (INPUT = 0.90)

JSI METAL = 0.29 (F) (INPUT = 1.00)

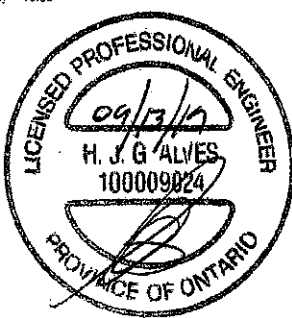

Structural component only

DWG# T-1923430

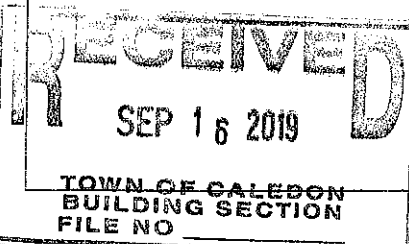

JOB NAME 405486	TRUSS NAME H3S-Cond1	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.300 S May 10 2019 MITek Industries, Inc. Fri Sep 13 10:42:52 2019 Page 1
ID:0dJueNb1pNAXJNn9U?SyYcERz-V18BCsXK0kNjxJu0dZ0aG38d2vxnNaPtSiYkZaye4gH


Scale = 1/32"

LUMBER		N. L. G. A. RULES		CHORDS SIZE		DRY		LUMBER		DESCR.	
A - D	2x4	DRY	No.2	SFF	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	REQD		
D - G	2x4	DRY	No.2	SFF	VERT	HORZ	GROSS REACTION	BRG	BRG		
J - B	2x4	DRY	No.2	SFF	UP	DOWN	UP	IN-SX	IN-SX		
H - F	2x4	DRY	No.2	SFF	J	H	854	0	854	0	5-8
J - H	2x4	DRY	No.2	SFF	H	J	854	0	854	0	MECHANICAL
ALL WEBS EXCEPT		2x3 DRY No.2		SFF		A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H MINIMUM BEARING LENGTH AT JOINT H = 1-8.					
DAY: SEASONED LUMBER.											
PLATES (table is in inches)											
JT TYPE	PLATES	W	LEN	Y	X						
B TMV+P	MT20	3.0	4.0								
C TMWW-t	MT20	4.0	6.0								
D TTW-w	MT20	4.0	6.0								
E TMWW-t	MT20	4.0	6.0								
F TMV+P	MT20	3.0	4.0								
H BMVVW-t	MT20	4.0	4.0								
I BMVVW-t	MT20	4.0	4.0								
J BMVVW-t	MT20	4.0	4.0								
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.											
DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER											
BEARINGS											
UNFACTORED REACTIONS											
1ST LCASE MAX/MIN COMPONENT REACTIONS											
JT COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL					
J	.599	424 / 0	0 / 0	0 / 0	0 / 0	175 / 0					
H	.599	424 / 0	0 / 0	0 / 0	0 / 0	175 / 0					
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J											
BRACING											
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.											
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.											
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.											
LOADING											
TOTAL LOAD CASES: (4)											
CHORDS											
MEMB. FORCE (LBS)											
FACTORED VERT. LOAD LC1 MAX											
(PLF) CSI (LC)											
UNBRAC LENGTH FR-TO											
WEBS											
MEMB. FORCE (LBS)											
MAX. FACTORED MAX											
CSI (LC)											
FR-TO											
A-B											
B-C											
C-D											
D-E											
E-F											
F-G											
G-H											
H-I											
I-J											
J-K											
K-L											
L-M											
M-N											
N-O											
O-P											
P-Q											
Q-R											
R-S											
S-T											
T-U											
U-V											
V-W											
W-X											
X-Y											
Y-Z											
Z-AA											
AA-BB											
BB-CC											
CC-DD											
DD-EE											
EE-FF											
FF-GG											
GG-HH											
HH-II											
II-JJ											
JJ-KK											
KK-LL											
LL-MM											
MM-NN											
NN-OO											
OO-PP											
PP-QQ											
QQ-RR											
RR-SR											
SR-TT											
TT-UU											
UU-VV											
VV-WW											
WW-XX											
XX-YY											
YY-ZZ											
ZZ-AA											
AA-BB											
BB-CC											
CC-DD											
DD-EE											
EE-FF											
FF-GG											
GG-HH											
HH-II											
II-JJ											
JJ-KK											
KK-LL											
LL-MM											
MM-NN											
NN-OO											
OO-PP											
PP-QQ											
QQ-RR											
RR-SR											
SR-TT											
TT-UU											
UU-VV											
VV-WW											
WW-XX											
XX-YY											
YY-ZZ											
ZZ-AA											
AA-BB											
BB-CC											
CC-DD											
DD-EE											

JOB NAME 405486	TRUSS NAME H35-Cord2	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.300 S May 10 2019 Mitek Industries, Inc. Fri Sep 13 10:42:53 2019 Page 1
ID:08dJueNb1pNAXJN9U?SyyCERz_DiZPBm1VaZTTCBGXpGhOnJH0610hNh51ye4gG

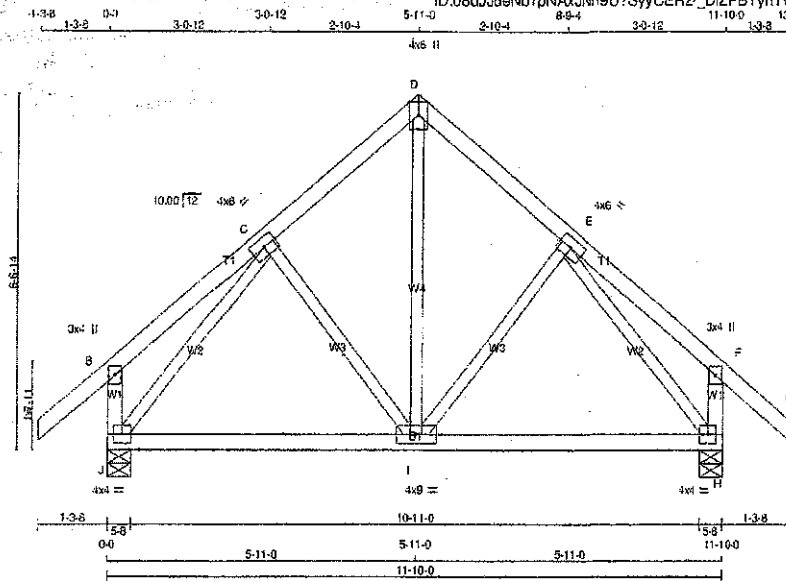

Scale = 1:37.7

TOTAL WEIGHT = 5 X 57 = 345 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - B	2x4	DRY	No.2
J - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMW-p	MT20	3.0	4.0		
C TMWW-I	MT20	4.0	6.0		
D TWW-p	MT20	4.0	6.0	Edge	
E TMWW-I	MT20	4.0	6.0		
F TMW-p	MT20	3.0	4.0		
H BMWW-I	MT20	4.0	4.0		
I BMWW-I	MT20	4.0	9.0		
J BMWW-I	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORIZ	UPLIFT
J	854	0	854	0
H	854	0	854	0

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM	LIVE	WIND	DEAD	SOIL
J	599	424 / 0	0 / 0	0 / 0	0 / 0	175 / 0	0 / 0	0 / 0
H	599	424 / 0	0 / 0	0 / 0	0 / 0	175 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED	FORCE	MAX
MEMB.	FORCE	(PLF)	(LBS)	(LBS)	(LBS)	(LBS)	LENGTH	(LBS)	(LBS)	(LBS)
FR-TO	FROM	TO	FROM	TO	TO	FR-TO	FROM	TO	FROM	TO
A-B	0 / 45	-102.0	-102.0	0.14 (1)	10.00	I-D	0 / 345	0.08 (1)		
B-C	0 / 22	-102.0	-102.0	0.14 (1)	10.00	I-E	-135 / 0	0.05 (1)		
C-D	-477 / 0	-102.0	-102.0	0.11 (1)	6.25	C-I	135 / 0	0.05 (1)		
D-E	-477 / 0	-102.0	-102.0	0.11 (1)	6.25	J-G	-705 / 0	0.26 (1)		
E-F	0 / 22	-102.0	-102.0	0.14 (1)	10.00	E-H	-705 / 0	0.26 (1)		
F-G	0 / 45	-102.0	-102.0	0.14 (1)	10.00					
J-B	-257 / 0	0.0	0.0	0.03 (1)	7.81					
H-F	-257 / 0	0.0	0.0	0.03 (1)	7.81					
J-I	0 / 434	-18.5	-18.5	0.21 (4)	10.00					
I-H	0 / 434	-18.5	-18.5	0.21 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	29.0	PSF
DL	=	8.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	42.4	PSF	

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, CBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.39")
CALCULATED VERT. DEFL.(LL) = L/969 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.39")
CALCULATED VERT. DEFL.(TL) = L/969 (0.03")

CSI: TC=0.14/1.00 (A-B:1), BC=0.21/1.00 (I-J:4),
WB=0.25/1.00 (E-H:1), SSI=0.11/1.00 (D-E:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1657 788	1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.55 (H) (INPUT = 0.90)
JSI METAL= 0.17 (E) (INPUT = 1.00)

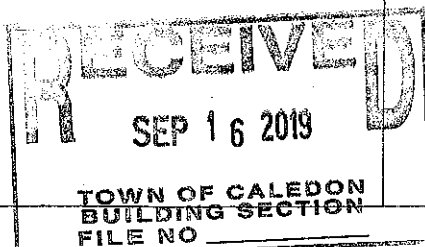


Structural component only
DWG# T-1923432

JOB NAME 405486	TRUSS NAME H35G	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
				TRUSS_DESC.	

Tamawack Roof Truss, Burlington

Version 8.300 S May 10 2019 MITek Industries, Inc. Fri Sep 13 10:42:54 2019 Page 1
ID:08dJueNb1pNAxJNn9U?SyCERz-SPGxoXZaYLDAd2Pl_22LUDzXtJhWJawIRdTy84gF

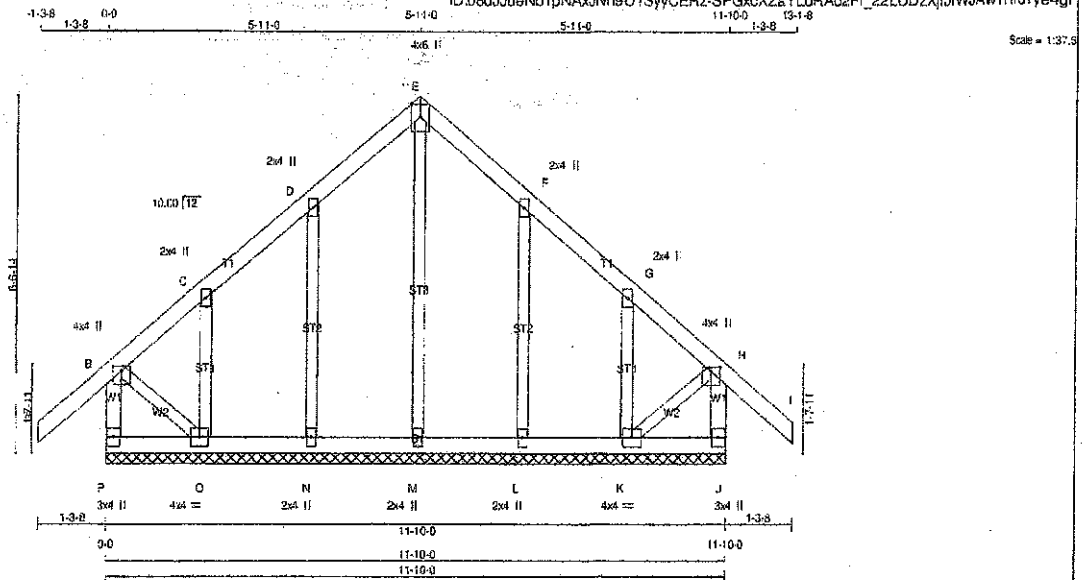

TOTAL WEIGHT = 4 X 58 = 230 lb (M)

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
P - B	2x4	DRY	No.2	SFF
A - E	2x4	DRY	No.2	SFF
E - I	2x4	DRY	No.2	SFF
J - H	2x4	DRY	No.2	SFF
P - J	2x4	DRY	No.2	SFF

ALL WEBS 2x3 DRY No.2 SFF
ALL GABLE WEBS 2x3 DRY No.2 SFF
DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2'-0" OC.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C, D, F, G					
C TMVW+w	MT20	2.0	4.0		
E TTW+p	MT20	4.0	8.0	Edge	
H TMVW+p	MT20	4.0	4.0	1.00	2.00
J BMV1+p	MT20	3.0	4.0		
K BMVW1-i	MT20	4.0	4.0		
L, M, N					
L BMV1+w	MT20	2.0	4.0		
O BMVW1-i	MT20	4.0	4.0		
P BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

CHORDS

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. UNBRAC LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRAC LENGTH (LC)
FR-TO				FR-TO		
P-B	-312 / 0	0.0	0.0 0.03 (1)	M-E	-148 / 0	0.10 (1)
A-B	0 / 45	-102.0	-102.0 0.14 (1)	N-D	-245 / 0	0.09 (1)
B-C	-57 / 0	-102.0	-102.0 0.13 (1)	O-C	-128 / 0	0.02 (1)
C-D	-10 / 0	-102.0	-102.0 0.07 (1)	L-F	-245 / 0	0.09 (1)
D-E	-29 / 0	-102.0	-102.0 0.07 (1)	K-G	-128 / 0	0.02 (1)
E-F	-29 / 0	-102.0	-102.0 0.07 (1)	B-O	0 / 25	0.01 (1)
F-G	-10 / 0	-102.0	-102.0 0.07 (1)	C-H	0 / 25	0.01 (1)
G-H	-57 / 0	-102.0	-102.0 0.13 (1)			
H-I	0 / 45	-102.0	-102.0 0.14 (1)			
J-H	-312 / 0	0.0	0.9 0.03 (1)			
P-O	0 / 0	-18.5	-18.5 0.02 (4)			
O-N	0 / 18	-18.5	-18.5 0.02 (4)			
N-M	0 / 11	-18.5	-18.5 0.02 (4)			
M-L	0 / 11	-18.5	-18.5 0.02 (4)			
L-K	0 / 16	-18.5	-18.5 0.02 (4)			
K-J	0 / 0	-18.5	-18.5 0.02 (4)			



DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	29.0	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	42.4	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(65 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

CSL: TC=0.14/1.00 (H-1), BC=0.02/1.00 (K L-4)
WB=0.01/1.00 (E-M-1), SSI=0.08/1.00 (H-1-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP (DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	
MAX	MIN	MAX	MIN
MT20	618	354	1667
	798	1937	1666

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg

JSI GRIP = 0.24 (H) (INPUT = 0.90)
JSI METAL = 0.13 (F) (INPUT = 1.00)

Structural component only
DWG# T-1923433

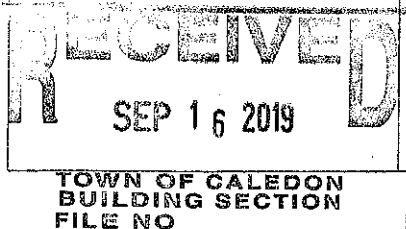

JOB NAME: 405493

TRUSS NAME: H35A-Cond2

QUANTITY: 12

PLY: 1

JOB DESC: GREEN PARK HOMES

TRUSS DESC:

DRWG NO:

Version 8.300 5 May 10 2019 MTek Industries, Inc. Fri Sep 13 11:12:18 2019 Page 1

ID: VXLWYAVIZ1H5x8yp_cqjmyYf6R9-onspv47K18pjvQ4SijrTHOMag68kpYTkAXDye4Eh

Scale = 1/320

Tamarack Roof Truss, Burlington

LUMBER

N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
N - B	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
N - M	2x4	DRY	No.2	SPF
M - C	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
I - E	2x4	DRY	No.2	SPF
I - H	2x4	DRY	No.2	SPF
ALL WEBS	2x4	DRY	No.2	SPF
K - D	2x3	DRY	No.2	SPF
K - E	2x3	DRY	No.2	SPF
C - K	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	HORZ	DOWN	HORZ
N	854	0	854	0
H	854	0	854	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 1-8.

UNFACTORED REACTIONS

JT	1ST LOASE	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
N	599	424	0	0	0	0	175	0
H	599	424	0	0	0	0	175	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.87 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	FORCE (LBS)	VERT. LOAD	LC1	MAX	CS1 (LC)	UNBRAC	MAX	WESS	MEMB.	MAX. FACTORED	FORCE (LBS)	MAX	CS1 (LC)
FR-TO															
A-B	0	45									K-D	0	302		0.07 (1)
B-C	-1082	0									K-E	-455	0		0.18 (1)
C-D	-572	0									C-K	-456	0		0.18 (1)
D-E	-572	0									N-L	-15	0		0.00 (1)
E-F	-1082	0									B-L	0	851		0.14 (1)
F-G	0	45									J-H	-15	0		0.00 (1)
G-H	-832	0									J-F	0	851		0.14 (1)
H-F	-832	0													
N-M	0	10													
M-L	0	13													
L-C	0	48													
L-K	0	885													
K-J	0	885													
J-I	0	13													
I-E	0	48													
I-H	0	10													

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 29.0 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.35")

CALCULATED VERT. DEFL. (LL) = L/999 (0.01")

ALLOWABLE DEFL. (TL) = L/360 (0.35")

CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CS1: TO=0.27/1.00 (D-E:1), BC=0.20/1.00 (K-L:1), WB=0.18/1.00 (C-K:1), SS1=0.17/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1867
	618	354	1867
	618	354	1867
	618	354	1867
	618	354	1867

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.89 (I) (INPUT = 0.90)

JSI METAL= 0.50 (F) (INPUT = 1.00)

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	6.0	Edge	
C	TMVW-l	MT20	4.0	4.0	2.00	1.25
D	TMVW+p	MT20	4.0	6.0	Edge	
E	TMVW-l	MT20	4.0	4.0	2.00	1.25
F	TMVW+p	MT20	4.0	6.0	Edge	
G	BMVW-l	MT20	4.0	4.0		
H	BMVW+p	MT20	3.0	4.0		
J	BMVW+l	MT20	8.0	9.0	4.50	3.75
K	BMVW-l	MT20	4.0	9.0		
L	BMVW+l	MT20	8.0	9.0	4.50	3.75
M	BMVW+p	MT20	3.0	4.0	2.00	Edge
N	BMVW-l	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

Structural component only

DRWG# T-1923457

RECEIVED

SEP 16 2019


TOWN OF CALEDON

BUILDING SECTION

FILE NO

[illegible]

JOB NAME 405486	TRUSS NAME H36-Cond2	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESG.	

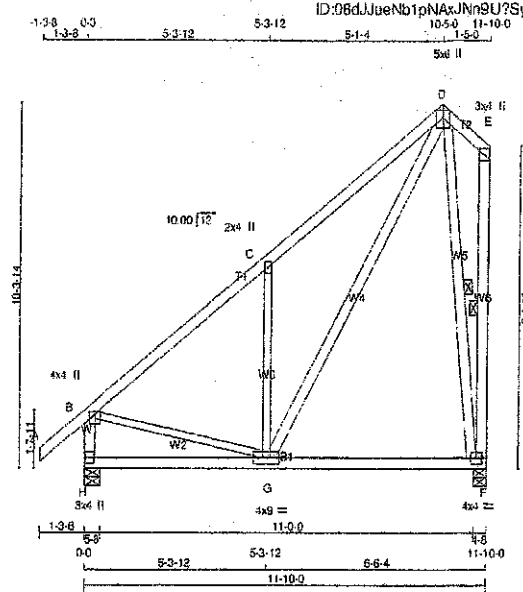

TOTAL WEIGHT = 4 X 77 = 308 lb (M/F)

LUMBER

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - E	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
EXCEPT			
D - F	2x4	DRY	No.2
G - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C TMW+w	MT20	2.0	4.0		
D TTVW+p	MT20	5.0	6.0	Edge	
E TMVW+p	MT20	3.0	4.0		
F BMVW+I	MT20	4.0	4.0		
G BMVW+I	MT20	4.0	9.0		
H BMV+P	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
H	854	0	854	0	5-8	5-8
F	713	0	713	0	4-8	4-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
H	599	424 / 0	0 / 0	0 / 0	0 / 0	175 / 0	0 / 0
F	502	343 / 0	0 / 0	0 / 0	0 / 0	159 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-F, D-F.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB	CHORDS			WEBS		
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRAC LENGTH (FT)	MAX. CSI (LC)
FR-TO						
A-B	0 / 45	-102.0	-102.0 0.14 (1)	10.00	G-C	643 / 0 0.37 (1)
B-C	533 / 0	-102.0	-102.0 0.36 (1)	8.25	B-G	0 / 454 0.10 (1)
C-D	589 / 0	-102.0	-102.0 0.36 (1)	8.25	D-F	598 / 0 0.31 (1)
D-E	0 / 0	-102.0	-102.0 0.03 (1)	10.00	G-D	0 / 750 0.12 (1)
H-B	-818 / 0	0.0	0.0 0.09 (1)	7.81		
F-E	-72 / 0	0.0	0.0 0.03 (1)	6.25		
H-G	0 / 0	-18.5	-18.5 0.19 (4)	10.00		
G-F	0 / 84	-18.5	-18.5 0.19 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 29.0 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(85 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL (LL) = L/360 (0.39")

CALCULATED VERT. DEFL (LL) = L/999 (0.01")

ALLOWABLE DEFL (TL) = L/360 (0.39")

CALCULATED VERT. DEFL (TL) = L/999 (0.08")

CSI: TC=0.36/1.00 (C-D-1), BC=0.19/1.00 (F-G-X), WB=0.37/1.00 (C-G-1), SS=0.20/1.00 (B-C-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRIP (DRY) (PS)	SHEAR (PL)	SECTION (PL)
MAX MIN MAX MIN MAX MIN	618 354 1667 758 1987 1655		

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.76 (B) (INPUT = 0.90)

JSI METAL = 0.34 (C) (INPUT = 1.00)




Structural component only
DWG# T-1923435

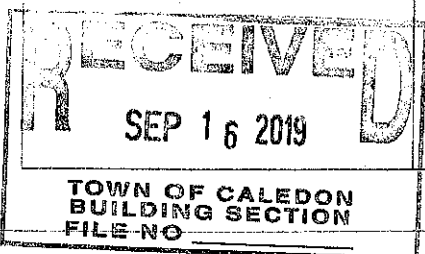

JOB NAME 405486	TRUSS NAME J3	QUANTITY 28	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.300 S May 10 2019 Mitek Industries, Inc. Fri Sep 13 10:42:57 2019 Page 1
ID:08dJueNbtpNaxJnn9U?SyCERz-s_y4FZbT:G??14n_Q6dz6rPFwfy2dccc?VEoye4gC

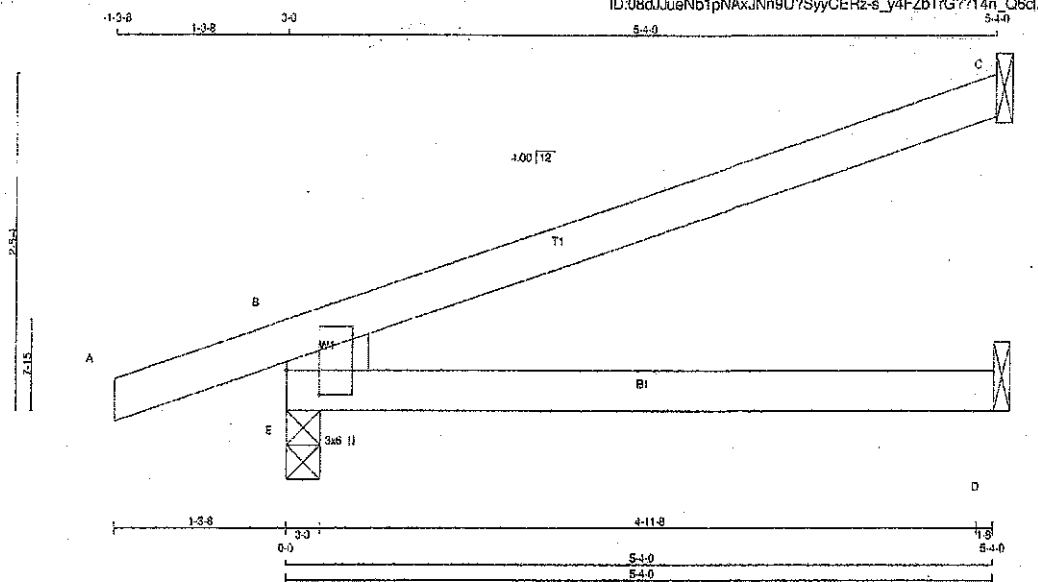

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	SPF	SPF
E - B	2x8	DRY	No.2	SPF	SPF
A - C	2x4	DRY	No.2	SPF	SPF
E - D	2x4	DRY	No.2	SPF	SPF

DRY, SEASONED LUMBER.

PLATES (table is in inches)						
JT TYPE	PLATES	W	LEN	Y	X	
E	TMBMV1+p	MT20	3.0	6.0	2.25	2.75

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
E	538	0	538	0	0	3-0	3-0	3-0	3-0
C	204	0	204	0	0	1-8	1-8	1-8	1-8
D	37	0	42	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
E	375	271.0	0.0	0.0	0.0	105.0
C	140	116.0	0.0	0.0	0.0	24.0
D	30	0.0	0.0	0.0	0.0	30.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. CS1 (LBS)	MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. CS1 (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
E-B	-477.0	0.0	0.0	0.05 (4)	7.81		
A-B	0.22	-102.0	-102.0	0.13 (1)	10.00		
B-C	-22.0	-102.0	-102.0	0.49 (1)	6.25		
E-D	0.0	-18.5	-18.5	0.15 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = U/999 (0.02")

CS1: TC=0.49/1.00 (B-C:1), BC=0.15/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS1=0.25/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSD) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (E) (INPUT = 0.50)
JSI METAL = 0.09 (E) (INPUT = 1.00)

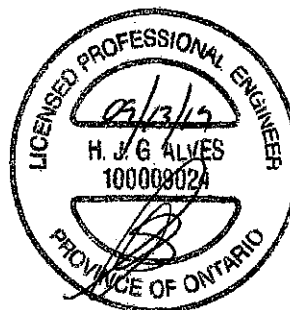

Structural component only
DWG# T-1923436

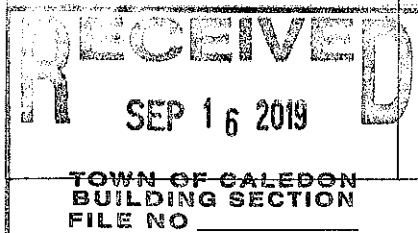

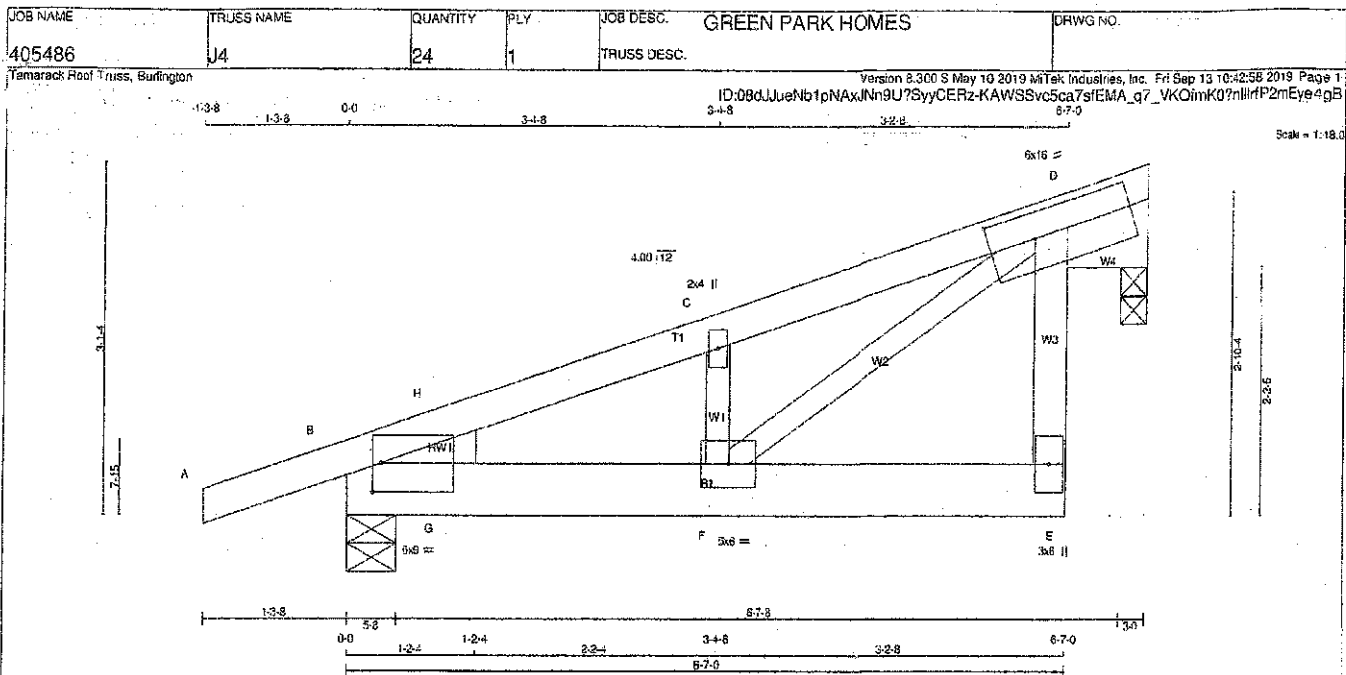

LUMBER

N.T. & A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
B - E	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMBH1-I	MT20	6.0	9.0	3.00	1.00
C TMBW1-w	MT20	2.0	4.0		
D TMBW1-I	MT20	6.0	16.0	2.75	5.00
E BMBW1-p	MT20	3.0	5.0		
F BMBW1-I	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX	HEEL WEDGE
	VERT	HORZ	DOWN	HORZ			
D	397	0	397	0	3-0	3-0	
B	533	0	533	0	5-8	5-8	2x4 L

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): D

UNFACTORED REACTIONS

JT	COMBINED	MAX./MIN. COMPONENT REACTIONS					SOIL
		1ST LOOSE	SNOW	LIVE	PERM. LIVE	WIND	
D	279	191 / 0	0 / 0	0 / 0	0 / 0	88 / 0	0 / 0
B	378	269 / 0	0 / 0	0 / 0	0 / 0	104 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNSHEATHED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRAC LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO								
A-B	0 / 8	-102.0	-102.0	0.13 (1)	10.00	F-C	-343 / 0	0.95 (1)
B-H	-579 / 0	-102.0	-102.0	0.02 (1)	5.25	F-D	0 / 608	0.14 (1)
H-C	-510 / 0	-102.0	-102.0	0.09 (1)	6.25	G-H	-1 / 23	0.00 (1)
C-D	-518 / 0	-102.0	-102.0	0.12 (1)	6.25			
E-D	0 / 46	0.0	0.0	0.01 (4)	10.00			
B-G	0 / 493	-18.5	-18.5	0.08 (1)	10.00			
G-F	0 / 493	-18.5	-18.5	0.10 (1)	10.00			
F-E	0 / 0	-18.5	-18.5	0.04 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 28.0	PSF
	DL = 8.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 42.4	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.22")
CALCULATED VERT. DEFL.(LL) = L/589 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.22")
CALCULATED VERT. DEFL.(TL) = L/589 (0.01")

CS1: TC=0.13/1.00 (A-B:1), BC=0.10/1.00 (F-G:1), WB=0.14/1.00 (D-F:1), SS=0.14/1.00 (C-D:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
	MAX	MIN	MAX MIN
MT20	518	354	1667 788 1987 1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.28 (F) (INPUT = 0.90)
JSI METAL = 0.13 (F) (INPUT = 1.00)

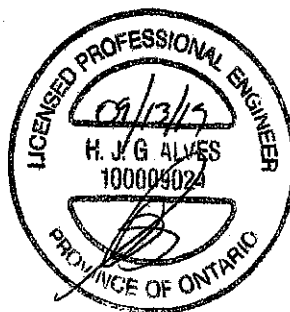


Structural component only
DWG# T-1923437

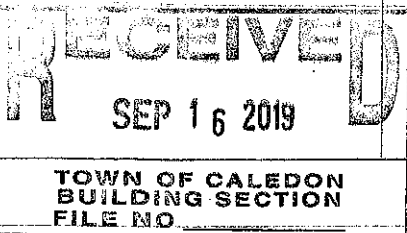

JOB NAME 405486	TRUSS NAME J8	QUANTITY 24	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.300 S May 10 2019 Mitek Industries, Inc. Fri Sep 13 16:43:00 2019 Page 1
ID:gyo4zloNr65nTgrsvuoXHy/Q5b-HZdDtdL7BNauYWy5F9SbtTy8hkFEN2Iyu9r7ye4g9

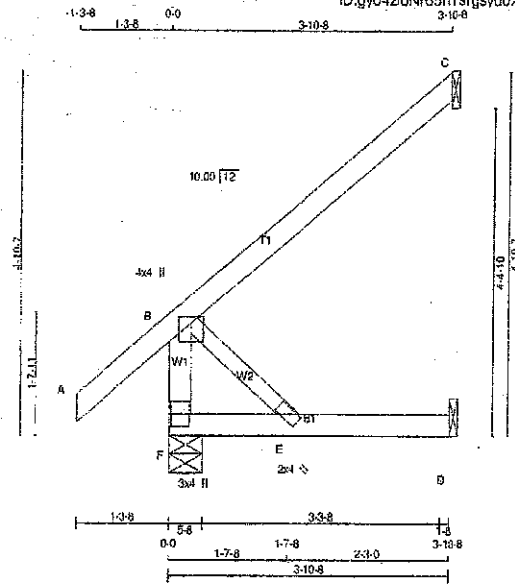

Scale = 1:27.3

TOTAL WEIGHT = 24 X 15 = 367 lb

LUMBER				DESCR.	
N. L. G. A. RULES	SIZE	LUMBER		SPF	
CHORDS					
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
E BMV+w	MT20	2.0	4.0		
F BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
JT	GROSS REACTION	GROSS REACTION	BRG	BRG	
	VERT	DOWN	HORIZ	UPLIFT	IN-SX
F	375	0	375	0	5-8
C	198	0	198	0	1-8
D	36	0	40	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST LOAGE	MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
F	261	193 / 0	0 / 0	0 / 0	0 / 0	69 / 0	0 / 0	
C	136	112 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0	
D	29	0 / 0	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS		MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	LC1 MAX	MEMB.	FORCE
	(LBS)	(PLF)	CSI (LC)		(LBS)
FR-TO		FROM TO	UNBRAC	FR-TO	
			LENGTH		
F-B	-339 / 0	0.0	0.04 (1)	3-E	0 / 0
A-B	0 / 45	-102.0	-102.0 0.15 (5)		0.00 (1)
B-C	0 / 0	-102.0	-102.0 0.25 (1)		
F-E	0 / 0	-18.5	-18.5 0.08 (4)		10.00
E-D	0 / 0	-18.5	-18.5 0.08 (4)		10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. DL = 29.0 PSF
DL = 6.0 PSF
BOT CH. DL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24" IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19')
CALCULATED VERT. DEFL.(LL) = L/999 (0.00')
ALLOWABLE DEFL.(TL) = L/360 (0.19')
CALCULATED VERT. DEFL.(TL) = L/999 (0.01')

CSI: TC=0.26/1.00 (B-C:1), BC=0.08/1.00 (D-E:4),
WB=0.00/1.00 (B-E:1), SSI=0.12/1.00 (B-C:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
	MAX	MIN	MAX	MIN	MAX
MT20	618	354	1687	788	1987


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.26 (B) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)

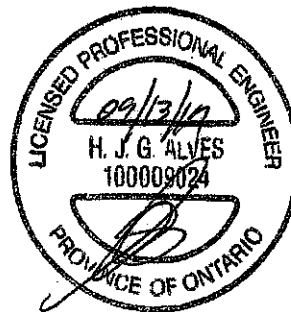

Structural component only
DWG# T-1923438

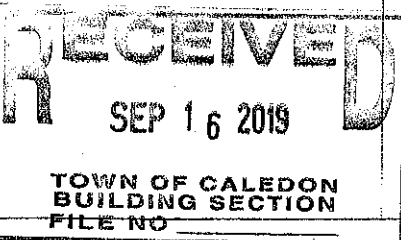


JOB NAME 405490	TRUSS NAME J13	QUANTITY 24	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	----------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.300 S May 10 2019 Mitek Industries, Inc. Fri Sep 13 10:59:25 2019 Page 1

ID:08dJlueNb1pNAXJNn9U7SyyCERz-x3facOYQ9UqZwJstcR7TmCsBsSXID1oLnXye4Qm

Scale = 1:15.6

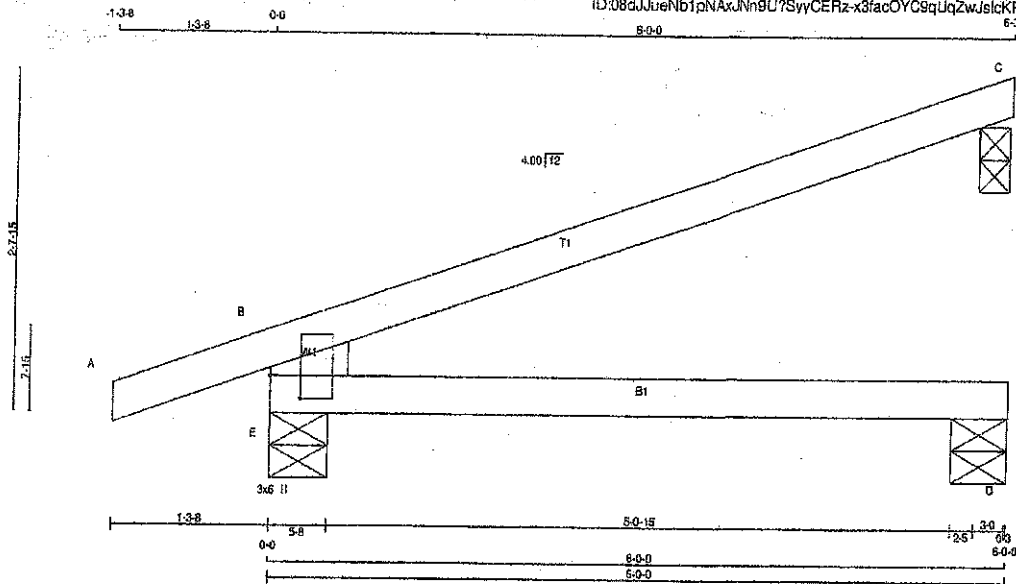

TOTAL WEIGHT = 24 X 16 = 392 lb

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	LUMBER	DESCR.
E - B	2x6	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B					
E					
E	TMBMV1+p	MT20	3.0	6.0	2.25 2.75

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	UP/LIFT
E	588	0	588	0
C	230	0	230	0
D	42	0	42	0

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	411	285 / 0	0 / 0	0 / 0	0 / 0	116 / 0	0 / 0	0 / 0
C	158	131 / 0	0 / 0	0 / 0	0 / 0	27 / 0	0 / 0	0 / 0
D	34	0 / 0	0 / 0	0 / 0	0 / 0	34 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO								
E-B	-519 / 0	0.0	0.0	0.08 (4)	7.81			
A-B	0 / 22	-102.0	-102.0	0.13 (1)	10.00			
B-C	-24 / 0	-102.0	-102.0	0.63 (1)	6.25			
E-D	0 / 0	-18.5	-18.5	0.19 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 20.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, CBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(53 % OF 37.6 P.S.F. G.S.L. PLUS 3.4 P.S.F. RAIN LOAD) EQUALS 20.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.63/1.00 (B-C:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (V&O), SS=0.28/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY



TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1867 1866

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.26 (E) (INPUT = 0.90)
JSI METAL = 0.10 (E) (INPUT = 1.00)

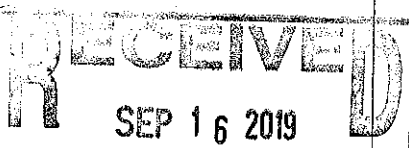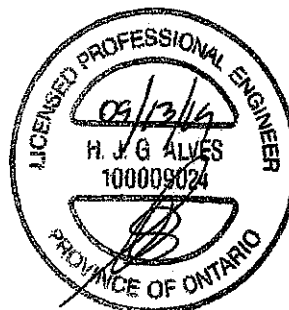


TOWN OF CALEDON
BUILDING SECTION
FILE NO

Structural component only
DWG# T-1923453

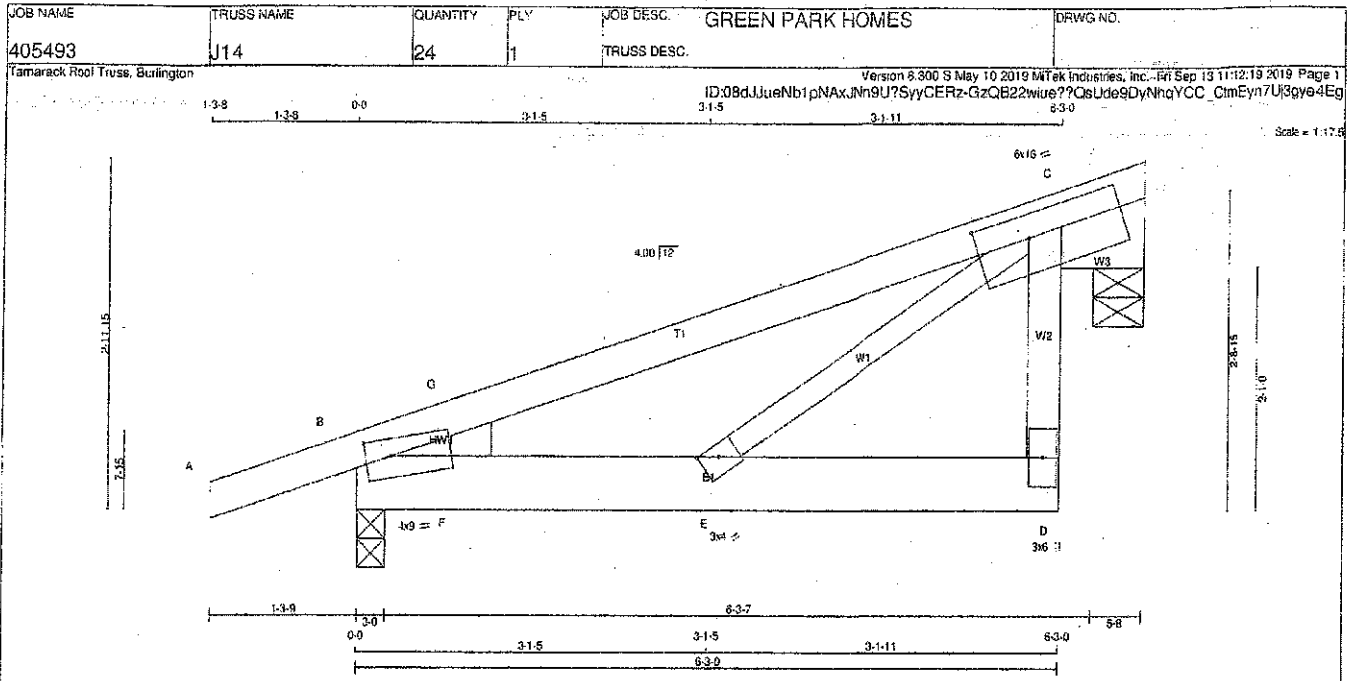

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. SPF A - C 2x4 DRY No.2 SPF D - C 2x4 DRY No.2 SPF D - D 2x6 DRY No.2 SPF ALL WEBS 2x3 DRY DRY, SEASONED LUMBER.			DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 29.0 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 42.4 PSF SPACING = 24.0 IN. CC THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF BCBC 2018, CBC 2012 - CSA 088-09, CSA 088-14 - TPIC 2011, TPIC 2014 (55% OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL. (LL) = L/360 (0.21") CALCULATED VERT. DEFL. (LL) = L/999 (0.01") ALLOWABLE DEFL. (TL) = L/360 (0.21") CALCULATED VERT. DEFL. (TL) = L/999 (0.02") CSI: TO=0.33/1.00 (C-G:1), BC=0.28/1.00 (B-F:1), WB=0.10/1.00 (C-E:1), SS=0.24/1.00 (B-F:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 1.00 AUTOSOLVE LEFT HEEL ONLY TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1067 758 1987 1856 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP = 0.33 (E) (INPUT = 0.90) JSI METAL = 0.11 (E) (INPUT = 1.00)		
PLATES (table is in inches) JT TYPE PLATES W LEN Y X B TMBH1-m MT20 4.0 9.0 1.75 2.75 C TMVWW1-t MT20 6.0 16.0 2.50 5.50 D BMV4-p MT20 3.0 6.0 E BMV-w MT20 3.0 4.0 2.00 1.25			BEARINGS FACTORED MAXIMUM FACTORED INPUT REORD GROSS REACTION GROSS REACTION BRG BRG HEEL JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX WEDGE C 377 0 377 0 0 5-8 5-8 B 513 0 513 0 0 3-0 3-0 2x4 L		
UNFACTORED REACTIONS 1ST CASE MAX/MIN COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL C 365 181 / 0 0 / 0 0 / 0 84 / 0 0 / 0 B 359 259 / 0 0 / 0 0 / 0 100 / 0 0 / 0			BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS MAX. FACTORED FORCE VERT. LOAD LC1 MAX. FACTORED FORCE VERT. LOAD LC1 MEMB. (LBS) (PLF) CSI (LC) UNBRACED LENGTH FR-TO MEMB. MAX. FACTORED FORCE VERT. LOAD LC1 FR-TO (LBS) (PLF) CSI (LC) UNBRACED LENGTH FR-TO MEMB. MAX. FACTORED FORCE VERT. LOAD LC1 A-B 0 / 8 -102.0 -102.0 0.13 (1) 10.00 E-C 0 / 455 0.10 (1) B-G -263 / 0 -102.0 -102.0 0.28 (1) 6.25 F-G -560 / 0 0.00 (1) G-C -394 / 0 -102.0 -102.0 0.33 (1) 6.25 D-C -6 / 24 0.0 0.0 0.01 (4) 7.81 B-F 0 / 359 -18.5 -18.5 0.28 (1) 10.00 F-E 0 / 359 -18.5 -18.5 0.28 (1) 10.00 E-D 0 / 0 -18.5 -18.5 0.07 (1) 10.00		

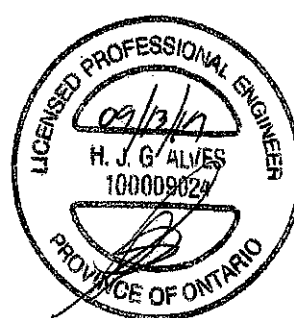

RECEIVED
SEP 16 2019
TOWN OF CALEDON
BUILDING SECTION
FILE NO

Structural component only
DWG# T-1923458





isDesign™

Client:
Project:
Address:Date: 2/2019
Designer:
Job Name: 405486
Project #:

Page 1 of 2

B1 S-P-F #2 2.000" X 10.000" 2-Ply - PASSED

Level: Level

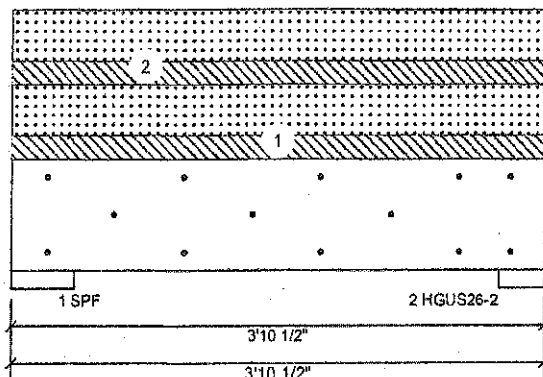**Member Information**

Type: Girder
Plies: 2
Moisture Condition: Dry
Deflection LL: 360
Deflection TL: 360
Importance: Normal

Application: Roof (Residential)
Slope: 0/12
Design Method: LSD
Building Code: NBCC 2015 / OBC 2012
Load Sharing: No
Deck: Not Checked
Vibration: Not Checked

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Live	Dead	Snow	Wind
1	0	185	401	0
2	0	174	376	0

Bearings and Factored Reactions


Bearing	Length	Cap. React D/L lb	Total Ld. Case	Ld. Comb.
1 - SPF	5.500"	8%	232 / 602	833 L 1.25D+1.5S
2 - HGUS...	4.000"	11%	217 / 564	781 L 1.25D+1.5S

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	536 ft-lb	2'	6039 ft-lb	0.089 (9%)	1.25D+1.5S	L
Unbraced	536 ft-lb	2'	5734 ft-lb	0.094 (9%)	1.25D+1.5S	L
Shear	669 lb	12"	3984 lb	0.168 (17%)	1.25D+1.5S	L
LL Defl inch	0.002 (L/21944)	2'	0.107 (L/360)	0.020 (2%)	S	L
TL Defl inch	0.003 (L/15009)	2'	0.107 (L/360)	0.020 (2%)	D+S	L


Design Notes

- 1 Fasten all plies using 3 rows of Pneumatic Gun Nail (.120x3.25") at 12" o.c. Maximum end distance not to exceed 6".
- 2 Refer to last page of calculations for fasteners required for specified loads.
- 3 Girders are designed to be supported on the bottom edge only.
- 4 Top braced at bearings.
- 5 Bottom braced at bearings.
- 6 Lateral slenderness ratio based on single ply width.

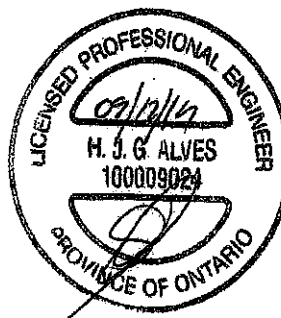

DWG NO. TAM T1923439
STRUCTURAL
COMPONENT ONLY 1/2

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Uniform		1-0-0	Far Face	13.4 PSF	0 PSF	29 PSF	0 PSF	
2	Uniform		5-11-0	Near Face	13.4 PSF	0 PSF	29 PSF	0 PSF	

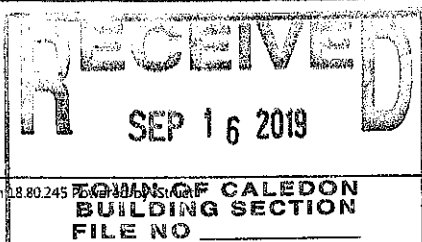

This design is valid until 12/11/2021

Manufacturer Info

Tamarack Roof Trusses
3255 North Service Road, ON
L7N 3G2
905-335-1115





isDesign™



Client:
Project:
Address:

Date: 2/20/19
Designer:
Job Name: 405486
Project #:

Page 2 of 2

B1 S-P-F #2 2.000" X 10.000" 2-Ply - PASSED


Level: Level

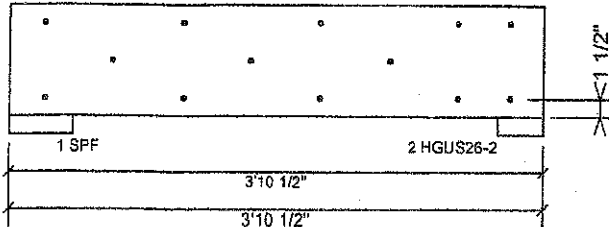

Multi-Ply Analysis

Fasten all plies using 3 rows of Pneumatic Gun Nail (.120x3.25") at 12" o.c. Maximum end distance not to exceed 6"


Capacity	52.4 %
Load	178.2 PLF
Yield Limit per Foot	340.0 PLF
Yield Limit per Fastener	113.3 lb.
Yield Mode	g
Edge Distance	1 1/2"
Min. End Distance	3"
Load Combination	1.25D+1.5S
Duration Factor	1.00

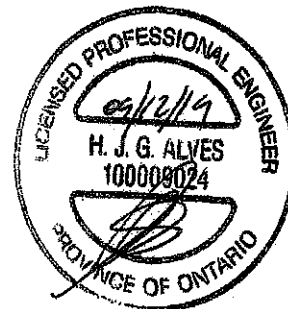

DWG NO. TAM 71923439
STRUCTURAL
COMPONENT ONLY 2/2

Manufacturer Info	Tamarack Roof Trusses 3255 North Service Road, ON L7N 3G2 905-335-1115
	TAMARACK LUMBER INC ALBA LUMBER GROUP

This design is valid until 12/11/2021

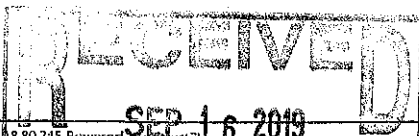

Version 8.80.245 Powered by isDesign™

TOWN OF CALEDON
BUILDING SECTION
FILE NO

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing -- an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258-259.


Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20-24.

Installation:

- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1 1/2" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:

- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.

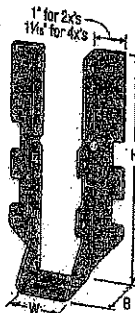


LUS28




LU26L




HUS210
(HUS26, HUS28,
and HHUS similar)



HGUS28-2



HHUS210-2



LJS26DS



Double-Shear
Nailing
Top View




Double-Shear
Nailing
Side View;
Do not
bend tab




Dome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,580

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

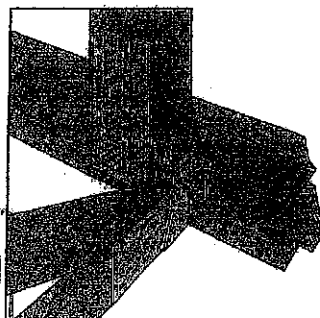


RECEIVED
SEP 16 2019
TOWN OF CALEDON
BUILDING SECTION
FILE NO

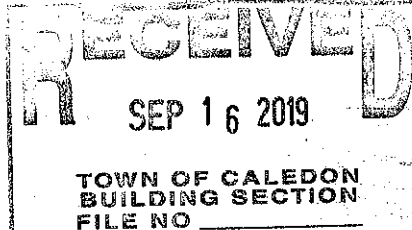

Simpson Strong-Tie® Wood Construction Connectors — Canadian Limit States Design

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie



HHUS/HGUS

See Hanger Options information on pp. 125–127.


HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.87 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value



**Top View HHUS Hanger
Skewed Right**
(joist must be bevel cut)
All joist nails installed on the
outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Plated Truss Connectors

Model No.	Ga.	Dimensions (in.)					Fasteners		Factored Resistance			
		W	H	B	d _e	Header	Joist		Uplift		S-P-F	
									(K _e = 1.15)	Normal	(K _e = 1.15)	Normal
									lb.	lb.	lb.	lb.
									kN	kN	kN	kN
Single 2x Sizes												
LUS24	18	1 1/8	3 1/4	1 1/4	2 1/4	(4) 10d	(2) 10d		710	1625	645	1155
LU24L	22	1 1/8	3	1 1/4	2 1/4	(4) 10d	(2) 10d x 1 1/2"		360	1020	320	725
LU24L	22	1 1/8	5	1 1/4	4 1/4	(6) 10d	(4) 10d x 1 1/2"		720	1605	645	1140
LUS26	18	1 1/8	4 1/4	1 1/4	3 1/4	(4) 10d	(4) 10d		1420	2170	1290	1630
HUS26	16	1 1/8	5 1/4	3	3 1/4	(14) 16d	(6) 16d		2705	4940	2085	3875
LJS26SS	18	1 1/8	5	3 1/4	4 1/4	(16) 16d	(6) 16d		2055	4265	1480	4115
HGUS26	12	1 1/8	5 1/4	5	4 1/4	(20) 16d	(8) 16d		2685	6625	2685	5700
LU28L	20	1 1/8	6 1/4	1 1/4	5 1/4	(8) 10d	(6) 10d x 1 1/2"		1140	2185	1020	1550
LUS28	18	1 1/8	6 1/4	1 1/4	3 3/4	(8) 10d	(4) 10d		1420	2620	1290	1790
HUS28	16	1 1/8	7 1/4	3	6 1/4	(22) 16d	(8) 16d		3605	5365	2675	4345
HGUS28	12	1 1/8	7 1/4	5	8 1/4	(36) 16d	(12) 16d		3310	7675	3310	6900
LU210L	20	1 1/8	8	1 1/4	7 1/4	(10) 10d	(6) 10d x 1 1/2"		1140	2485	1020	1770
LUS210	18	1 1/8	7 1/4	1 1/4	3 3/4	(8) 10d	(4) 10d		1420	2785	1290	2210

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_e is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 3/4" long. See pp. 27–28 for other nail sizes and information.

C-C-CAN2018 ©2017 SIMPSON STRONG-TIE COMPANY INC.

Simpson Strong-Tie® Wood Construction Connectors - Canadian Limit States Design




Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.



Model No.	Ga.	Dimensions (in.)					Fasteners		Factored Resistance			
		W	H	B	d _g	Header	Joist		D-F-T		S-P-F	
									Uplift (K _u = 1.15)	Normal (K _n = 1.00)	Uplift (K _u = 1.15)	Normal (K _n = 1.00)
									lb.	lb.	lb.	lb.
									kN	kN	kN	kN
Double 2x Sizes												
LUS24-2	18	3 1/4	3 1/4	2	1 1/2	(4) 16d	(2) 16d		835	2020	590	1435
LUS26-2	18	3 1/4	4 1/4	2	4	(4) 16d	(4) 16d		1720	2595	1545	1920
HHUS26-2	14	3 1/4	5 1/4	3	3 1/4	(14) 16d	(6) 16d		2850	7335	2085	5205
HGUS26-2	12	3 1/4	5 1/4	4	4 1/4	(20) 16d	(8) 16d		4385	8950	3110	6355
LUS28-2	18	3 1/4	7	2	4	(6) 16d	(4) 16d		1720	3325	1545	2575
HHUS28-2	14	3 1/4	7 1/4	3	6 1/4	(22) 16d	(8) 16d		3785	8940	2675	6345
HGUS28-2	12	3 1/4	7 1/4	4	6 1/4	(36) 16d	(12) 16d		6070	12980	4310	9215
LUS210-2	18	3 1/4	9	2	6	(8) 16d	(8) 16d		2580	4500	2320	3195
HHUS210-2	14	3 1/4	9 1/4	3	8	(30) 16d	(10) 16d		4670	9660	4235	7000
HGUS210-2	12	3 1/4	9 1/4	4	8 1/4	(46) 16d	(16) 16d		6840	14015	4855	10270
Triple 2x Sizes												
HGUS26-3	12	4 1/4	5 1/4	4	4 1/4	(20) 16d	(8) 16d		4385	8950	3110	6355
HGUS28-3	12	4 1/4	7 1/4	4	6 1/4	(36) 16d	(12) 16d		6070	12980	4310	9215
HHUS210-3	14	4 1/4	9	3	7 1/4	(30) 16d	(10) 16d		4670	9660	4235	6865
HGUS210-3	12	4 1/4	9 1/4	4	8 1/4	(46) 16d	(16) 16d		6840	14015	4855	10400
Quadruple 2x Sizes												
HGUS26-4	12	6 1/4	5 1/4	4	4 1/4	(20) 16d	(8) 16d		4385	8950	3110	6355
HGUS28-4	12	6 1/4	7 1/4	4	6 1/4	(36) 16d	(12) 16d		6070	12980	4310	9215
HHUS210-4	14	6 1/4	8 1/4	3	7 1/4	(30) 16d	(10) 16d		4670	9660	4235	7210
HGUS210-4	12	6 1/4	9 1/4	4	8 1/4	(46) 16d	(16) 16d		6840	14015	4855	10400
HGUS212-4	12	6 1/4	10 1/4	4	10 1/4	(56) 16d	(20) 16d		7640	14995	5425	10645
HGUS214-4	12	6 1/4	12 1/4	4	11 1/4	(66) 16d	(22) 16d		10130	16400	7195	11645
4x Sizes												
LUS46	18	3 1/4	4 1/4	2	3 1/4	(4) 16d	(4) 16d		1720	2595	1545	1920
HHUS46	14	3 1/4	5 1/4	3	3 1/4	(14) 16d	(6) 16d		2850	7335	2085	5205
HGUS46	12	3 1/4	5 1/4	4	4 1/4	(20) 16d	(8) 16d		4385	8950	3110	6355
LUS48	18	3 1/4	6 1/4	2	3 1/4	(6) 16d	(4) 16d		1720	3325	1545	2575
HHUS48	14	3 1/4	7 1/4	3	6 1/4	(22) 16d	(8) 16d		3785	8940	2675	6345
HGUS48	12	3 1/4	7 1/4	4	6 1/4	(36) 16d	(12) 16d		6070	12980	4310	9215
LUS410	18	3 1/4	8 1/4	2	5 1/4	(8) 16d	(6) 16d		2580	4500	2320	3195
HGUS410	12	3 1/4	9	4	8 1/4	(46) 16d	(16) 16d		6840	14015	4855	10270
HGUS412	12	3 1/4	10 1/4	4	10 1/4	(56) 16d	(20) 16d		7640	14995	5425	10645
HGUS414	12	3 1/4	12 1/4	4	11 1/4	(66) 16d	(22) 16d		10130	16400	7195	11645



Plated Truss Connectors

C-C-0402018 ©2017 SIMPSON STRONG-TIE COMPANY INC.

See footnotes on p. 258.

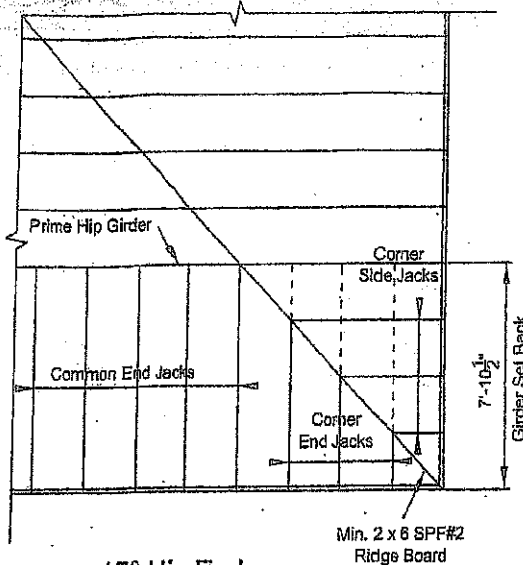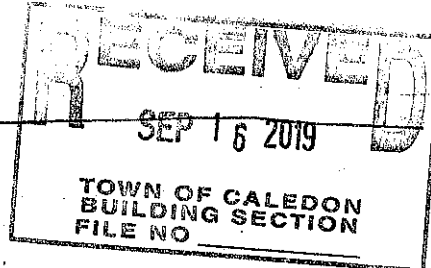

45° Hip End



LUMBER SPECIFICATION

TOP CHORD : 2 x 4 SPF#2
 BOTTOM CHORD : 2 x 4 SPF#2
 WEBS : 2 x 3 SPF#2
 UNLESS OTHERWISE SHOWN


DESIGN LOAD

TOP CHORD SNOW LOAD : 40.5 P.S.F.
 TOP CHORD DEAD LOAD : 3.0 P.S.F.
 BOTTOM CHORD LIVE LOAD : 0.0 P.S.F.
 BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.


TOTAL LOAD

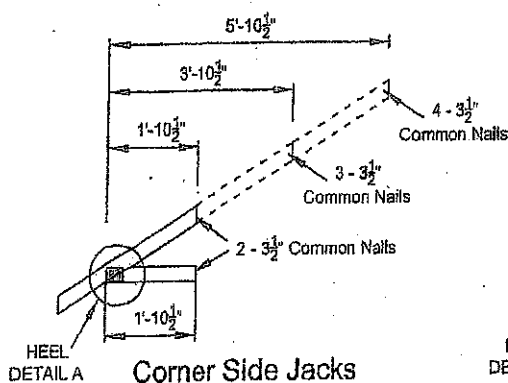


Corner Side Jacks

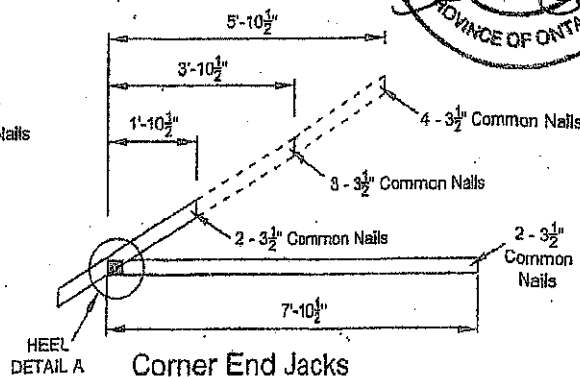

Corner End Jacks

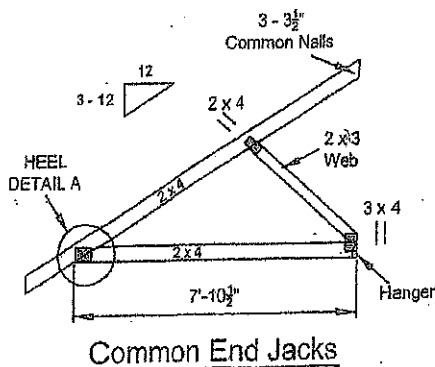


Common End Jacks

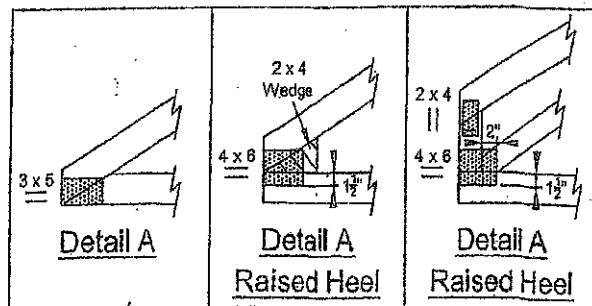

NOTE: DESIGN CONFORMS TO PART 9, O.B.C. 2012 (L.S.D. DESIGN)

T-1800217

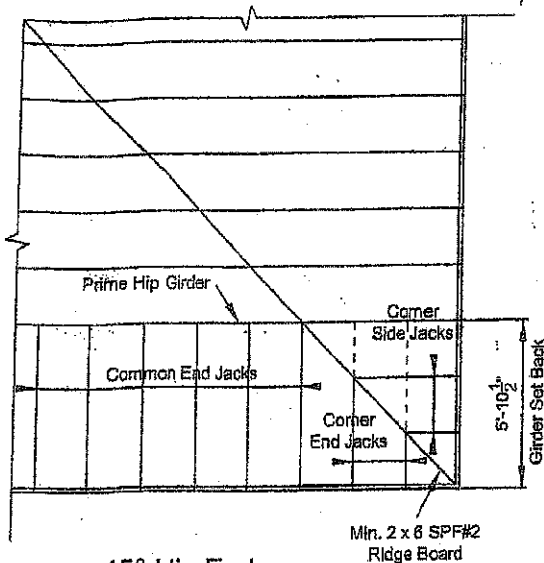

45° Hip End






LUMBER SPECIFICATION

TOP CHORD : 2 x 4 SPF#2
 BOTTOM CHORD : 2 x 4 SPF#2
 WEBS : 2 x 3 SPF#2
 UNLESS OTHERWISE SHOWN

DESIGN LOAD

TOP CHORD SNOW LOAD : 40.5 P.S.F.
 TOP CHORD DEAD LOAD : 3.0 P.S.F.
 BOTTOM CHORD LIVE LOAD : 0.0 P.S.F.
 BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.

TOTAL LOAD : 50.5 P.S.F

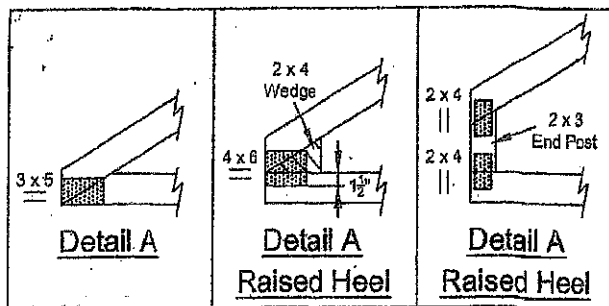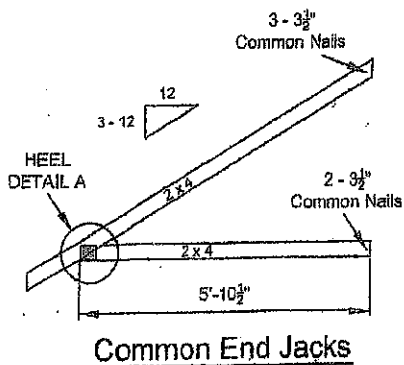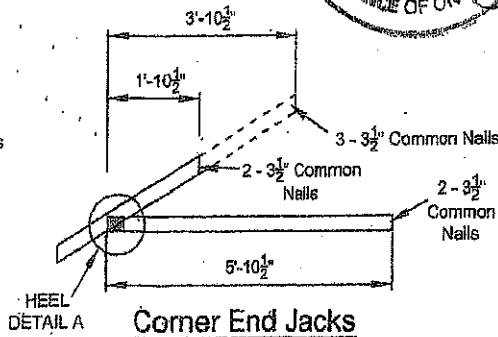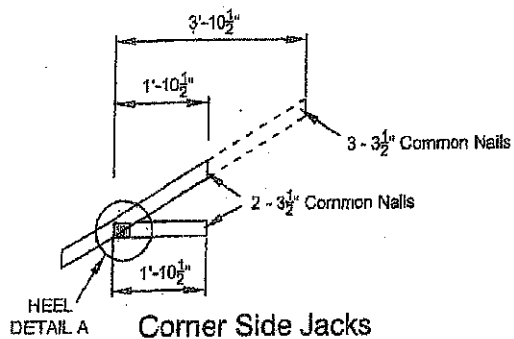


NOTE: DESIGN CONFORMS TO PART 9, O.B.C. 2012 (L.S.D. DESIGN)

T-1800216

Symbols

PLATE LOCATION AND ORIENTATION

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/4" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.

Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate-Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

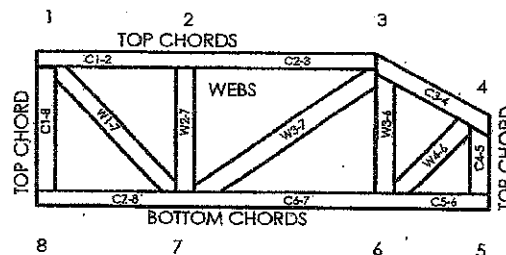

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved



MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MIT-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

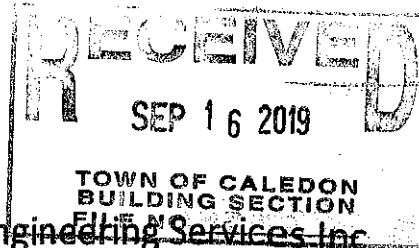

Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1800218

Feb 09, 2018