

CONSTRUCTION NOTES (Unless otherwise noted)

ALL CONSTRUCTION TO ADHERE TO THESE PLANS AND SPEC'S AND TO CONFORM TO THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE CODES AND AUTHORITIES HAVING JURISDICTION. THESE REQUIREMENTS ARE TO BE TAKEN AS MINIMUM SPECIFICATIONS. ONT. REG. 332/12-2012 OBC.

1. ROOF CONSTRUCTION

NO.210 (10.25kg/m2) ASPHALT SHINGLES, 10mm (3/8") PLYWOOD SHEATHING WITH "H" CLIPS. APPROVED WOOD TRUSSES @ 610mm (24") O.C. MAX. APPROVED EAVES PROTECTION TO EXTEND 900mm (3'-0") FROM EDGE OF ROOF AND MIN. 300mm (12") BEYOND INNER FACE OF EXTERIOR WALL. (EAVES PROTECTION NOT REQ'D FOR ROOF SLOPES 8:12 OR GREATER). 38x89 (2"x4") TRUSS BRACING @ 1830mm (6'-0") O.C. AT BOTTOM CHORD. PREFIN. ALUM. ENVELOUGH, FASCIA, RVL & VENTED SOFFIT. PROVIDE ICE & WATER SHIELD TO ALL ROOF/WALL SURFACES SUSCEPTIBLE TO ICE DAMMING. ROOF SHEATHING TO BE FASTENED 150 (6") C/F ALONG EDGES & INTERMEDIATE SUPPORTS WHEN TRUSSES SPACED GREATER THAN 406 (16"). AT VENTILATION 1:30 OF INSULATED CEILING AREA WITH MIN. 25% AT EAVES & MIN. 25% AT RIDGE (OBC 9.1.1.2).

2. FRAME WALL CONSTRUCTION (2"x6") (SB-12-TABLE 3.1.1.2.A) SIDING AS PER ELEV., 19x38 (1"x2") VERTICAL WOOD FURRING, CONTIN. SHEATHING MEMBRANE, 11mm (7/16") EXT. TYPE SHEATHING OR OBC COMPLIANT EQUIVALENT, 38x140 (2"x6") STUDS @ 400mm (16") O.C., RSI 3.67 (R22) INSULATION AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm (1/2") INT. DRYWALL FINISH. SIDING TO BE MIN. 200mm (8") ABOVE FINISH GRADE. REFER TO OBC SB-12, CHAPTER 3 FOR REQUIRED MINIMUM THERMAL INSULATION REQUIREMENTS.

2B. FRAME WALL CONSTRUCTION (2"x6") - GARAGE WALLS SIDING AS PER ELEV., 19x38 (1"x2") VERTICAL WOOD FURRING, CONTIN. SHEATHING MEMBRANE, 11mm (7/16") EXT. TYPE SHEATHING OR OBC COMPLIANT EQUIVALENT, 38x89 (2"x4") STUDS @ 400mm (16") O.C. (MAX. HEIGHT 3000mm (9'-10")), WITH APPR. DIAGONAL WALL BRACING. REFER TO NOTE 19 WHERE FLOOR EXISTS ABOVE GARAGE. SIDING TO BE MIN. 200mm (8") ABOVE FINISH GRADE.

2C. STUCCO WALL CONSTRUCTION (2"x6") (SB-12-TABLE 3.1.1.2.A) STUCCO CLADDING SYSTEM CONFORMING TO O.B.C. 9.2.7.1.1.(2) & 9.28 THAT EMPLOY A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXT. AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 25mm (1") MIN. EXTRUDED OR EXPANDED RIGID POLYSTYRENE ON APPR. AIR/MOISTURE BARRIER ON 38x89 (2"x4") STUDS @ 406 (16") O.C. (MAX. HEIGHT 3000mm (9'-10")), WITH APPR. DIAGONAL WALL BRACING. REFER TO NOTE 19 WHERE FLOOR EXISTS ABOVE GARAGE. STUCCO TO BE MIN. 200 (8") ABOVE FINISH GRADE.

2D. STUCCO WALL CONSTRUCTION (2"x6") - GARAGE WALLS STUCCO CLADDING SYSTEM CONFORMING TO O.B.C. 9.2.7.1.1.(2) & 9.28 THAT EMPLOY A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 25mm (1") MIN. EXTRUDED OR EXPANDED RIGID POLYSTYRENE ON APPROVED AIR/MOISTURE BARRIER ON 38x89 (2"x4") STUDS @ 406 (16") O.C. (MAX. HEIGHT 3000mm (9'-10")), WITH APPR. DIAGONAL WALL BRACING. REFER TO NOTE 19 WHERE FLOOR EXISTS ABOVE GARAGE. STUCCO TO BE MIN. 200 (8") ABOVE FINISH GRADE.


2E. WALLS ADJACENT TO ATTIC - NO CLADDING 11mm (7/16") EXT. TYPE SHEATHING OR OBC COMPLIANT EQUIVALENT, 38x140 (2"x6") STUDS @ 400mm (16") O.C., RSI 3.87 (R22) INSULATION AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm (1/2") INTERIOR DRYWALL FINISH. MID-HEIGHT BLOCKING REQ'D. IF NO SHEATHING APPLIED. REFER TO OBC SB-12, CHAPTER 3 FOR ADDITIONAL THERMAL INSULATION REQUIREMENTS.

3. BRICK VENEER CONSTRUCTION (2"x6") (SB-12-TABLE 3.1.1.2.A) 50mm (4") FACE BRICK, 25mm (1") AIR SPACE, 22x180x76mm (7/8"x7"x3/4") GALV. METAL TIES @ 406mm (16") O.C. HORIZONTAL 610mm (24") O.C. VERTICAL. APPROVED SHEATHING PAPER, 11mm (7/16") EXTERIOR TYPE SHEATHING OR OBC COMPLIANT EQUIVALENT, 38x140 (2"x6") STUDS @ 406mm (16") O.C., RSI 3.87 (R22) INSULATION AND APPROVED VAPOUR BARRIER WITH APPROVED CONTIN. AIR BARRIER 13mm (1/2") INT. DRYWALL FINISH. PROVIDE WEEP HOLES @ 600mm (32") O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER. BRICK TO BE MIN. 150mm (6") ABOVE FINISH GRADE. REFER TO OBC SB-12, CHAPTER 3 FOR REQUIRED MINIMUM THERMAL INSULATION REQUIREMENTS.

3B. BRICK VENEER CONSTRUCTION (2"x4") - GARAGE WALLS 30mm (4") FACE BRICK, 25mm (1") AIR SPACE, 22x180x76mm (7/8"x7"x3/4") GALV. METAL TIES @ 406mm (16") O.C. HORIZONTAL 610mm (24") O.C. VERTICAL. APPROVED SHEATHING PAPER, 11mm (7/16") EXTERIOR TYPE SHEATHING OR OBC COMPLIANT EQUIVALENT, 38x89 (2"x4") STUDS @ 406mm (16") O.C. (MAX. HEIGHT 3000mm (9'-10")), WITH APPROVED DIAGONAL WALL BRACING. REFER TO NOTE 19 WHERE FLOOR EXISTS ABOVE GARAGE. PROVIDE WEEP HOLES @ 600mm (32") O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER. BRICK TO BE MIN. 150mm (6") ABOVE FINISH GRADE.

3C. STUCCO WALL CONSTRUCTION (2"x6") (SB-12-TABLE 3.1.1.2.A) STUCCO CLADDING SYSTEM CONFORMING TO O.B.C. 9.2.7.1.1.(2) & 9.28 THAT EMPLOY A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 25mm (1") MIN. EXTRUDED OR EXPANDED RIGID POLYSTYRENE ON APPR. CONTIN. AIR/MOISTURE BARRIER ON 38x140 (2"x6") STUDS @ 406 (16") O.C., RSI 3.87 (R22) BATT INSUL. (APPR. 9 MIL. POLYETHYLENE VAPOUR BARRIER, 13mm (1/2") GYPSUM BOARD INTERIOR FINISH. STUCCO TO BE MIN. 200 (8") ABOVE FINISH GRADE. REFER TO OBC SB-12, CHAPTER 3 FOR REQUIRED MINIMUM THERMAL INSULATION REQUIREMENTS.

STRUDET INC.

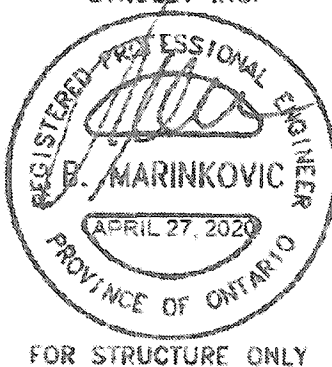

FOR STRUCTURE ONLY

INTERIOR STUD PARTITIONS

4. FOR BEARING PARTITIONS 38x89 (2"x4") @ 406mm (16") O.C. FOR 2 STOREYS AND 305mm (12") O.C. FOR 3 STOREYS. NON-BEARING PARTITIONS 38x89 (2"x4") @ 610mm (24") O.C. PROVIDE 38x89 (2"x4") BOTTOM STUDS @ 2'x11" BELOW FIN. GRADE. DRAINAGE LAYER IS NOT REQ'D. IF FOUNDATION WALL IS WATERPROOFED. MAXIMUM POUR HEIGHT 2390 (7'-10") ON 500x155 (20"x6") CONTINUOUS KEYS CONG. FTG. BRACE FTDN. WALL PRIOR TO BACKFILLING. ALL FOOTINGS SHALL REST ON NATURAL UNDISTURBED SOIL OR COMPACTED ENGINEERED FILL.

5. FOUNDATION WALL FOOTINGS: (9.15.3, 9.15.4, 9.15.2, 9.14.2.1.(2)) 200mm (8") POURED CONG. FTDN. WALL 150Pa (2200psi) WITH BITUMINOUS DAMPPROOFING AND DRAINAGE LAYER. DRAINAGE LAYER REQ'D. WHEN BASEMENT INSUL. EXTENDS 900 (2'-11") BELOW FIN. GRADE. DRAINAGE LAYER IS NOT REQ'D. IF FOUNDATION WALL IS WATERPROOFED. MAXIMUM POUR HEIGHT 2390 (7'-10") ON 500x155 (20"x6") CONTINUOUS KEYS CONG. FTG. BRACE FTDN. WALL PRIOR TO BACKFILLING. ALL FOOTINGS SHALL REST ON NATURAL UNDISTURBED SOIL OR COMPACTED ENGINEERED FILL.

STRIP FOOTINGS - FOR TOWNHOUSES

FOR STRIP FOOTING SIZES REFER TO BLOCK FOUNDATION PLAN. ASSUMED 120 KPa (16 p.s.i.) SOIL BEARING CAPACITY FOR TOWNHOUSES, TO BE VERIFIED ON SITE.

-MAXIMUM FLOOR LIVE LOAD OF 2.4KPa. (50psf.) PER FLOOR.
-REFER TO SOILS REPORT FOR SOIL CONDITIONS AND BEARING CAPACITY.

FOUNDATION DRAINAGE OBC 9.14.2. & 9.14.3

6. 100mm (4") DIA. FOUNDATION DRAINAGE TILE 150mm (6") CRUSHED STONE OVER AND AROUND DRAINAGE TILES.

7. BASEMENT SLAB OBC 9.3.1.6 (11b), 9.16.5 (1), 9.25.3.3 (15)

60mm (5/8") MIN. 25MPa (3600psi) CONG. SLAB ON 100mm (4") COARSE GRANULAR FILL OR 20MPa (3000psi) CONG. WITH DAMPPROOFING BELOW SLAB. UNDER SLAB INSULATION PER SB-12; 3.1.1.7.5(6) where required. ALL SLAB JOINTS & PENETRATIONS TO BE SEALED TO MAINTAIN AIR BARRIER.

8. WOOD SUBFLOORS (SEE OBC 9.23.14. & 9.30.2.1)

-19mm (3/4") MIN. T & G SUBFLOOR UNDER GROUND FLOOR FINISH FLOOR.
16mm (5/8") T&G SUBFLOOR UNDER SECOND FLOOR FINISH FLOOR.
16mm (5/8") PANEL-TYPE UNDERLAY FOR CERAMIC TILE APPLICATION.
6mm (1/4") PANEL-TYPE UNDERLAYMENT UNDER RESILIENT & PARQUET FLOORING.

9. ATTIC INSULATION (SB-12-TABLE 3.1.1.2.A) (SB-12-3.1.1.8)

RSI 10.56 (R60) BLOWN IN FIBRE INSULATION AND APPROVED VAPOUR BARRIER, 10mm (5/8") INT. DRYWALL FINISH OR APPROVED EQUAL. RSI 3.52 (R20) MIN. ABOVE INNER SURFACE OF EXTERIOR WALL.

10. ALL STAIRS/EXTERIOR STAIRS - OBC 9.8 -

UNIFORM RISE -5mm (1/4") MAX BETWEEN ADJACENT TREADS OR LANDINGS
-10mm (1/2") MAX BETWEEN VALLEYS & SHORTEST RISE IN FLIGHT

MAX. RISE = 200 (7'-7/8")
MIN. RUN = 210 (8'-1/4")
MIN. TREAD = 235 (9'-1/4")
MAX. NOSING = 25 (1")
MIN. HEADROOM = 1950 (6'-5")
RAIL @ LANDING = 900 (2'-11")
RAIL @ STAIR = 865 (2'-10") TO 985 (3'-2")
MIN. STAIR WIDTH = 860 (2'-10")

FOR CURVED STAIRS
MIN. RUN = 150 (8")
MIN. AVG. RUN = 200 (8")

HANDRAILS - OBC 9.8.7 -
FINISHED WAILING ON PICKETS SPACED MAXIMUM 100mm (4") BETWEEN PICKETS. CLEARANCE BETWEEN HANDRAIL AND SURFACE BEHIND IT TO BE 50 (2") MIN. HANDRAILS TO BE CONTINUOUS EXCEPT FOR NEWEL POST AT CHANGES OF DIRECTION.

INTERIOR GUARDS - OBC 9.8.8 -
INTERIOR GUARDS: 900mm (2'-11") MIN. HIGH.
EXTERIOR GUARDS - OBC 9.8.8 -
900mm (36") HIGH GUARD WHERE DISTANCE FROM PORCH TO FIN. GRADE IS LESS THAN 1800mm (71"). 1070mm (42") HIGH GUARD IS REQUIRED WHERE DISTANCE EXCEEDS 1800mm (71").

SILL PLATE ANCHORAGE
38x89 (2"x4") SILL PLATE WITH 13mm (1/2") DIA. ANCHOR BOLTS 200mm (8") LONG, EMBEDDED MIN. 100mm (4") INTO CONG. @ 2400mm (7'-10") O.C. CALLING OR 25 (1") MIN. MINERAL WOOL BETWEEN PLATE AND TOP OF FTDN. WALL.
USE NON-SHRINK GROUT TO LEVEL SILL PLATE WHEN REQUIRED.

BASEMENT INSULATION (SB-12-3.1.1.7, 9.25.3.3, 9.13.2.6)
FOUNDATION WALLS ENCLOSING HEATED SPACE SHALL BE INSULATED FROM THE UNDERSIDE OF THE SUBFLOOR TO NOT MORE THAN 200mm (8") ABOVE THE FINISHED FLOOR & NO CLOSER THAN 50mm (2") OF THE BASEMENT SLAB. RSI 3.52 (R20) BLANKET INSULATION TO HAVE APPROVED VAPOUR BARRIER. RECOMMEND DAMPPROOF WITH BUILDING PAPER BETWEEN THE FOUNDATION WALL AND INSULATION UP TO GRADE LEVEL. NOTE: FULL HEIGHT INSULATION AT COLD CELLAR WALLS. AIR BARRIER TO BE SEALED TO FOUNDATION WALL WITH CAULKING. CONTINUOUS INSULATION (6) IS NOT TO BE INTERRUPTED BY FRAMING.

BASEMENT BEARING STUD PARTITION
38x89 (2"x4") STUDS @ 406mm (16") O.C. 38x89 (2"x4") SILL PLATE ON DAMPPROOFING MATERIAL, 13mm (1/2") DIA. ANCHOR BOLTS 200mm (8") LONG, EMBEDDED MIN. 100mm (4") INTO CONG. @ 2400mm (7'-10") O.C. 100mm (4") HIGH CONG. CUB ON 500x155 (20"x6") CONG. FOOTING. ADD HORIZ. BLOCKING AT MID-HEIGHT IF WALL IS UNFINISHED.

15. STEEL BEARING COLUMN (SEE OBC 9.15.3.3)
80mm (3-1/2") DIA x 4.78mm (0.188") STL. COL. WITH A MIN. CAPACITY OF 108.6KN (24,000lbs.) WITH 150x150x9.5 (6"x6"x3/8") STL. TOP & BOTTOM PLATE.

15A. STEEL COLUMN
90mm (3-1/2") DIA x 4.78mm (0.188") STL. COL. WITH 100x100x6.0 (4"x4"x1/4") TOP & BOTTOM PLATES. FIELD WELD BOTTOM PLATE TO 100x250x12.5 (4"x10"x1/2") BASE PLATE C/W 2-12mm DIA. x 300mm LONG 500mm HOOK ANCHORS @ 150 (6") C/F. THE COLUMN TO STUD WALL WITH 2-32x3.175 (1-1/4"x1/8") STEEL STRAP WELDED TO COLUMN AND FASTENED TO STUD WITH 2-SDS 6.35x38 (1/4"x1/2") SCREWS MANUF. BY SIMPSON STRONG TIE.

CONCRETE PLASTER

16. BEAM POCKET OR 200x200 (8"x8") POURED CONG. INF. WALLS. EXHAUST AND INTAKE VENTS. SPV INTAKE TO BE A MIN. OF 1830mm (6'-0") FROM ALL EXHAUST TERMINALS. REFER TO GAS UTILIZATION CODE. ALL AIR INTAKES SHALL BE LOCATED SO THAT THEY ARE SEPARATED FROM KITCHEN EXHAUST BY 3.0M IN CONFORMANCE WITH O.B.C. DIV.-B TABLE 6.2.3.12.

17. 15x28 (1"x2") CONTINUOUS WOOD STRAPPING BOTH SIDES OF STEEL BEAM. (OBC 9.23.4.3.(c))

GARAGE SLAB

18. 100mm (4") 32MPa (4640psi) CONG. SLAB WITH 5-8% AIR ENTRAINMENT OR OPTIONAL 1/4" COARSE GRANULAR FILL WITH COMPACTED SUB-BASE OR COMPACTED NATIVE FILL. SLOPE TO FRONT (EXTERIOR) AT 1% MIN.

19. INTERIOR GARAGE WALLS & CEILING (SB-12-TABLE 3.1.1.2.A) 13mm (1/2") GYPSUM BOARD ON WALL AND CEILING BETWEEN HOUSE AND GARAGE. RSI 3.87 (R22) IN WALLS, RSI 5.46 (R31) IN CEILING. TAPE AND SEAL ALL JOINTS IN ACCORDANCE WITH O.B.C. 9.16.9.16. REFER TO SB-12, TABLE 3.1.1.2.A. FOR REQUIRED THERMAL INSULATION.

20. DOOR AND FRAME GASPROOFED. DOOR EQUIPPED WITH SELF CLOSING DEVICE AND WEATHERSTRIPPING P/R OBC 9.10.13.15.

EXTERIOR STEP

21. PRECAST CONCRETE STEP OR WOOD STEP NOT EXPOSED TO WEATHER. MAX. RISE 200mm (7-7/8") MIN. TREAD 250mm (9-2/32"). SEE OBC 9.8.9.2, 9.8.5.3. & 9.8.1.0.

22. DRYER VENT (OBC 9.2.3.8.(7) & 9.2.4.1.1) CAPPED DRYER EXHAUST VENTED TO EXTERIOR (USE 100mm (4") DIA. SMOOTH WALL VENT PIPE).

23. INSULATED ATTIC ACCESS (OBC 9.19.2.1. & SB12-3.1.1.8) ATTIC ACCESS HATCH WITH MIN. DIMENSION OF 545x700mm (21-1/2"x27-1/2") & A MIN. AREA OF 0.32 SQ.M. (3.44 SQ.FT.) WITH WEATHERSTRIPPING. RSI 3.52 (R20) RIGID INSULATION BACKING. SEE OBC SB-12, 3.1.1.8.

24. FIREPLACE CHIMNEYS - OBC 9.21 -
TOP OF FIREPLACE CHIMNEY SHALL BE 915mm (3'-0") ABOVE THE HIGHEST POINT AT WHICH IT COMES IN CONTACT WITH THE ROOF AND 610mm (2'-0") ABOVE THE ROOF SURFACE WITHIN A HORIZ. DISTANCE OF 3050mm (10'-0") FROM THE CHIMNEY.

UNFIN. CLOSETS

25. 4 SHELVES MIN. 350mm (14") DEEP.

26. MECHANICAL EXHAUST
MECHANICAL EXHAUST FAN VENTED TO EXTERIOR AS REQUIRED BY OBC 9.32.3.5. & 9.32.3.10.

27. STEEL BEARING PLATE FOR MASONRY WALLS
280x280x16 (11"x11"x5/8") STL. PLATE FOR STL BEAMS AND 280x280x12 (11"x11"x1/2") STL. PLATE FOR WOOD BEAMS. BEARING ON CONG. BLOCK PARTIALLY. ANCHORED WITH 2-19mm (3/4") x 200mm (8") LONG GALV. ANCHORS WITHIN SOLID BLOCK COURSE. LEVEL WITH NON-SHRINK GROUT.

27A. SOLID WOOD BEARING FOR WOOD STUD WALLS
SOLID BEARING TO BE AT LEAST AS WIDE AS THE SUPPORTED MEMBER. SOLID WOOD BEARING COMPOSED OF BUILT-UP WOOD STUDS TO BE CONSTRUCTED IN ACCORDANCE WITH OBC 9.17.4.2(2).

28. CLASS 'B' VENT
U.L.C. RATED CLASS 'B' VENT 610mm (2'-0") ABOVE THE POINT IN CONTACT WITH THE ROOF FOR SLOPES UP TO 9/12. REFER TO THE ONTARIO GAS UTILIZATION CODE.

29. BASEMENT WOOD POST (OBC 9.17.4.2)
3-38x140 (3"-2"x6") BUILT-UP POST ON METAL BASE SHOE ANCHORED TO CONG. WITH 12.7 DIA. BOLT. 406x406x203 (16"x16"x8") CONG. FTG. OR AS OTHERWISE SPECIFIED ON DRAWING.

30. STEPPED FOOTINGS (OBC 9.15.3.9)
MIN. HORIZ. STEP = 600mm (24")
MAX. VERT. STEP = 600mm (24")

31. SLAB ON GRADE
MIN. 100mm (4") CONCRETE SLAB ON GRADE ON 100mm (4") COARSE GRANULAR FILL. REINFORCED WITH 6x6-102x9x2 9 MESH PLACED NEAR MID-DEPTH OF SLAB. CONG. STRENGTH 32 MPa (4640 psi) WITH 5-8% AIR ENTRAINMENT OR COMPACTED SUB-GRADE UNDER SLAB INSULATION AS PER OBC SB-12, 3.1.1.7.5(6) AND SB-12, TABLE 3.1.1.2.A. where required. ALL JOINTS & PENETRATIONS OF INTERIOR SLABS TO BE SEALED TO MAINTAIN AIR BARRIER.

32. DIRECT VENTING GAS FURNACE VENT
DIRECT VENT FURNACE TERMINAL MIN. 900mm (36") FROM A GAS FLOOR/CEILING MIN. 300mm (12") ABOVE FIN. GRADE. FROM ALL OPENINGS, EXHAUST AND INTAKE VENTS. SPV INTAKE TO BE A MIN. OF 1830mm (6'-0") FROM ALL EXHAUST TERMINALS. REFER TO GAS UTILIZATION CODE. ALL AIR INTAKES SHALL BE LOCATED SO THAT THEY ARE SEPARATED FROM KITCHEN EXHAUST BY 3.0M IN CONFORMANCE WITH O.B.C. DIV.-B TABLE 6.2.3.12.

33. DIRECT VENTING GAS FIREPLACE VENT
DIRECT VENT GAS FIREPLACE VENT TO BE A MINIMUM 300mm (12") FROM ANY OPENING AND ABOVE FIN. GRADE. REFER TO GAS UTILIZATION CODE.

34. JOIST STRAPPING AND BRIDGING (SEE OBC 9.23.9.4)
16mm (5/8") T & G SUBFLOOR ON WOOD FLOOR JOISTS. FOR CERAMIC TILE APPLICATION (* SEE OBC 9.30.6. *) 6mm (1/4") PANEL TYPE UNDERLAY UNDER RESILIENT & PARQUET FLOORING. (* SEE OBC 9.30.2.4 *)
FLOOR JOISTS WITH SPANS OVER 2100mm (6'-11") TO BE BRIDGED WITH 38x38 (2"x2") CROSS BRACING OR SOLID BLOCKING @ 2100mm (6'-11") O.C. MAX. AND WHERE SPECIFIED BY JOIST TABLES A-1 OR A-2 STRAPPING SHALL BE 19x64 (1"x3") @ 2100mm (6'-11") O.C. UNLESS A PANEL TYPE CEILING FINISH IS APPLIED. (* SEE OBC 9.23.9.4. *)

35. EXPOSED BUILDING FACE - OBC 9.10.15.
EXTERIOR WALLS TO HAVE A FIRE RESISTANCE RATING OF NOT LESS THAN 45 min. WHERE LIMITING DISTANCE (L) IS LESS THAN 1.2M (3'-11"). WHERE THE L IS LESS THAN 600mm (1'-11") THE EXPOSING FACE SHALL BE CLAD IN NON-COMBUSTIBLE MATERIAL. SEE ELEVATIONS FOR ADDITIONAL NOTES.

36. GOLD CELLAR PORCH SLAB (OBC 9.39.1)
FOR MAX. 2500 mm (8'-2") PORCH DEPTH (SHORTEST DIM.), 125mm (4 7/8") 32MPa (4640psi) CONG. SLAB WITH 5-8% AIR ENTRAINMENT. REINF. WITH 10M BARS @ 200mm (7 7/8") O.C. EACH WAY IN BOTTOM THIRD OF SLAB, 600x600 (23 5/8"x23 5/8") 10M DOWELS @ 600mm (23 5/8") O.C., ANCHORED IN PERIMETER FTDN. WALLS. SLOPE SLAB MIN. 1.0% FROM DOOR. SLAB TO HAVE MIN 75mm (3") BEARING ON FTDN. WALLS. PROVIDE (1) LINTELS OVER CELLAR DOOR AND WITH 100mm (4") END BEARING.

37. BRICK CHECK
THE FTDN. WALL SHALL NOT BE REDUCED TO LESS THAN 90mm (3-1/2") THICK TO A MAX. DEPTH OF 660mm (26") AND SHALL BE TIED TO THE FACING MATERIAL WITH METAL TIES SPACED 200mm (8") O.C. VERTICALLY AND 900mm (36") O.C. HORIZONTALLY. FILL SPACE BETWEEN WALL AND FACING SOLID WITH MORTAR.

38. CONVENTIONAL ROOF FRAMING (2.0KPa SNOW LOAD)
38x140 (2"x6") RAFTERS @ 405mm (16") O.C. FOR MAX 11'-7" SPAN. 38x184 (2"x8") RIDGE BOARD. 38x89 (2"x4") COLLAR TIES AT MIDSPANS. CEILING JOISTS TO BE 38x89 (2"x4") @ 406mm (16") O.C. FOR MAX. 2830mm (9'-3") SPAN & 38x140 (2"x6") @ 406 (16") O.C. FOR MAX. 4450mm (14'-7") SPAN.
RAFTERS FOR BUILT-UP ROOF TO BE 38x89 (2"x4") @ 610mm (24") O.C. WITH A 38x89 (2"x4") CENTRE POST TO THE TRUSS BELOW, LATERALLY BRACED @ 1800mm (6'-0") O.C. VERTICALLY.

39. TWO STOREY VOLUME SPACES
-FOR A MAXIMUM 5490 mm (18'-0") HEIGHT AND MAXIMUM SUPPORTED ROOF TRUSS LENGTH OF 6.0m. PROVIDE 2-38x140 (2"x6") SPR#2 CONTIN. STUDS @ 305mm (12") O.C. (TRIPLE UP AT EVERY THIRD DOUBLE STUD FOR BRICK WALLS) C/W 9.6 (3/8") THICK EXT. PLYWOOD SHEATHING. PROVIDE SOLID WOOD BLOCKING BETWEEN WOOD STUDS @ 1220 mm (4'-0") O.C. VERTICALLY. -FOR WALLS WITH HORIZ. DISTANCES NOT EXCEEDING 2800 mm (9'-5"), PROVIDE 38x140 (2"x6") STUDS @ 406 (16") O.C. WITH CONTINUOUS 2-38x140 (2"x6") TOP PLATES & 1-38x140 (1"x6") BOTTOM PLATE & MINIMUM OF 3-38x184 (3"x8") CONT. HEADER AT GRND. CEILING LEVEL TOE-NAILED & GLUED AT TOP, BOTTOM PLATES AND HEADERS.


40. EXPOSED FLOOR TO EXTERIOR (SB-12-TABLE 3.1.1.2.A)
PROVIDE RSI 5.46 (R31) INSULATION, APPROVED VAPOUR BARRIER AND CONTINUOUS AIR BARRIER, FINISHED SOFFIT.

41. PARTY WALLS
TYPICAL 1 HOUR RATED PARTYWALL.
REFER TO DETAILS FOR TYPE AND SPECIFICATIONS.


42. EXTERIOR WALLS FOR WALK-OUT CONDITIONS
THE EXTERIOR BASEMENT STUD TO BE 38x140 (2"x6") STUDS @ 406mm (16") O.C. OR 38x89 (2"x4") STUDS @ 305mm (12") O.C.

LOOSE STEEL LINTELS
L1 = 3-1/2" x 3-1/2" x 1/4" (90x90x6.0)
L2 = 4" x 3-1/2" x 5/16" (101x90x8.0)
L3 = 5" x 3-1/2" x 5/16" (125x90x8.0)
L4 = 6" x 3-1/2" x 3/8" (150x90x10.0)
L5 = 6" x 4" x 3/8" (150x100x10.0)
L6 = 7" x 4" x 3/8" (180x100x10.0)

LAMINATED VENEER UNDER (LV) BEAMS
LV1A = 1-1 3/4"x7 1/4" (1-45x184)
LV1B = 2-1 3/4"x7 1/4" (2-45x184)
LV1C = 3-1 3/4"x7 1/4" (3-45x184)
LV1D = 4-1 3/4"x7 1/4" (4-45x184)
LV1E = 5-1 3/4"x7 1/4" (5-45x184)
LV1F = 6-1 3/4"x7 1/4" (6-45x184)
LV1G = 7-1 3/4"x7 1/4" (7-45x184)
LV1H = 8-1 3/4"x7 1/4" (8-45x184)
LV1I = 9-1 3/4"x7 1/4" (9-45x184)
LV1J = 10-1 3/4"x7 1/4" (10-45x184)
LV1K = 11-1 3/4"x7 1/4" (11-45x184)
LV1L = 12-1 3/4"x7 1/4" (12-45x184)
LV1M = 13-1 3/4"x7 1/4" (13-45x184)
LV1N = 14-1 3/4"x7 1/4" (14-45x184)
LV1O = 15-1 3/4"x7 1/4" (15-45x184)
LV1P = 16-1 3/4"x7 1/4" (16-45x184)
LV1Q = 17-1 3/4"x7 1/4" (17-45x184)
LV1R = 18-1 3/4"x7 1/4" (18-45x184)
LV1S = 19-1 3/4"x7 1/4" (19-45x184)
LV1T = 20-1 3/4"x7 1/4" (20-45x184)
LV1U = 21-1 3/4"x7 1/4" (21-45x184)
LV1V = 22-1 3/4"x7 1/4" (22-45x184)
LV1W = 23-1 3/4"x7 1/4" (23-45x184)
LV1X = 24-1 3/4"x7 1/4" (24-45x184)
LV1Y = 25-1 3/4"x7 1/4" (25-45x184)
LV1Z = 26-1 3/4"x7 1/4" (26-45x184)
LV1AA = 27-1 3/4"x7 1/4" (27-45x184)
LV1AB = 28-1 3/4"x7 1/4" (28-45x184)
LV1AC = 29-1 3/4"x7 1/4" (29-45x184)
LV1AD = 30-1 3/4"x7 1/4" (30-45x184)
LV1AE = 31-1 3/4"x7 1/4" (31-45x184)
LV1AF = 32-1 3/4"x7 1/4" (32-45x184)
LV1AG = 33-1 3/4"x7 1/4" (33-45x184)
LV1AH = 34-1 3/4"x7 1/4" (34-45x184)
LV1AI = 35-1 3/4"x7 1/4" (35-45x184)
LV1AJ = 36-1 3/4"x7 1/4" (36-45x184)
LV1AK = 37-1 3/4"x7 1/4" (37-45x184)
LV1AL = 38-1 3/4"x7 1/4" (38-45x184)
LV1AM = 39-1 3/4"x7 1/4" (39-45x184)
LV1AN = 40-1 3/4"x7 1/4" (40-45x184)
LV1AO = 41-1 3/4"x7 1/4" (41-45x184)
LV1AP = 42-1 3/4"x7 1/4" (42-45x184)
LV1AQ = 43-1 3/4"x7 1/4" (43-45x184)
LV1AR = 44-1 3/4"x7 1/4" (44-45x184)
LV1AS = 45-1 3/4"x7 1/4" (45-45x184)
LV1AT = 46-1 3/4"x7 1/4" (46-45x184)
LV1AU = 47-1 3/4"x7 1/4" (47-45x184)
LV1AV = 48-1 3/4"x7 1/4" (48-45x184)
LV1AW

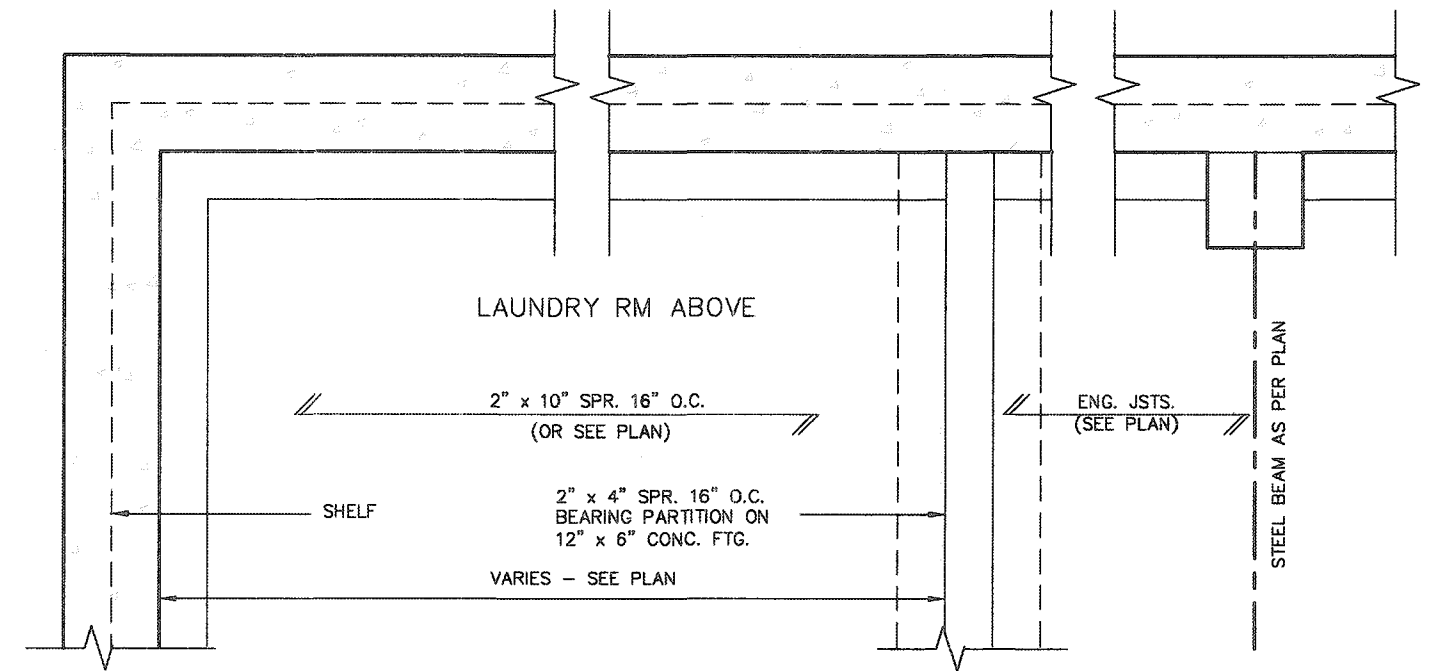

PARTIAL FOUNDATION PLAN

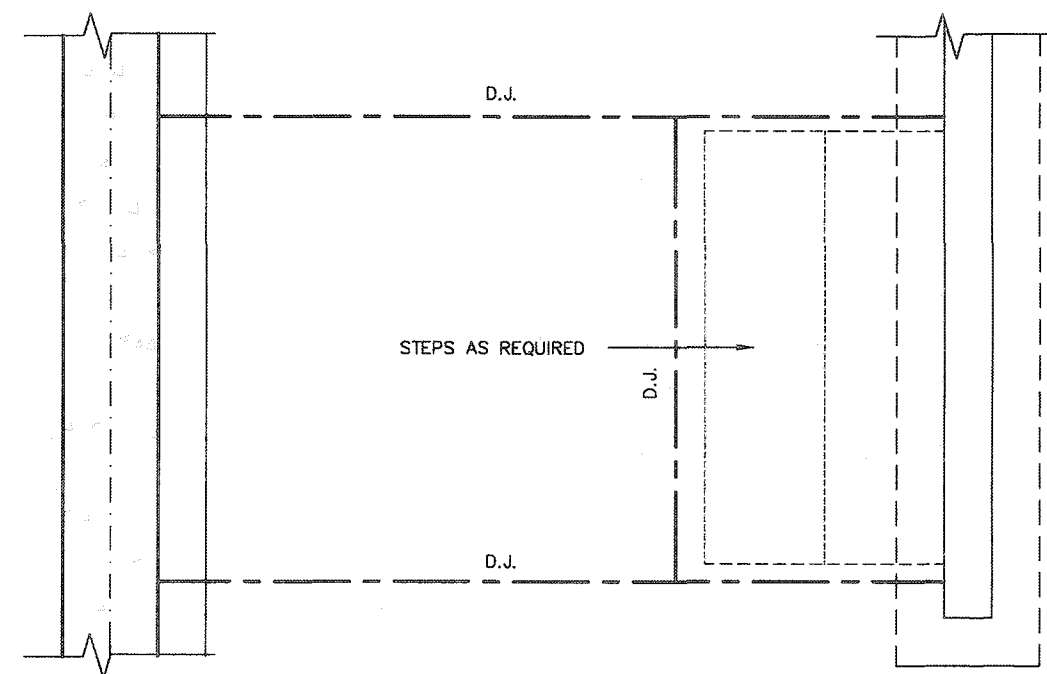

Permit No. 187706

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

SDC NOV. 9 2020

FOR CHIEF BUILDING OFFICIAL DAY

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department

OCT 06 2020

REC'D BY _____ DATE _____
REC'D TO _____ DATE _____

STRUDET INC.




FOR STRUCTURE ONLY



2012 CODE
COMPLIANCE PACKAGE A1

[illegible]


All drawings, specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.

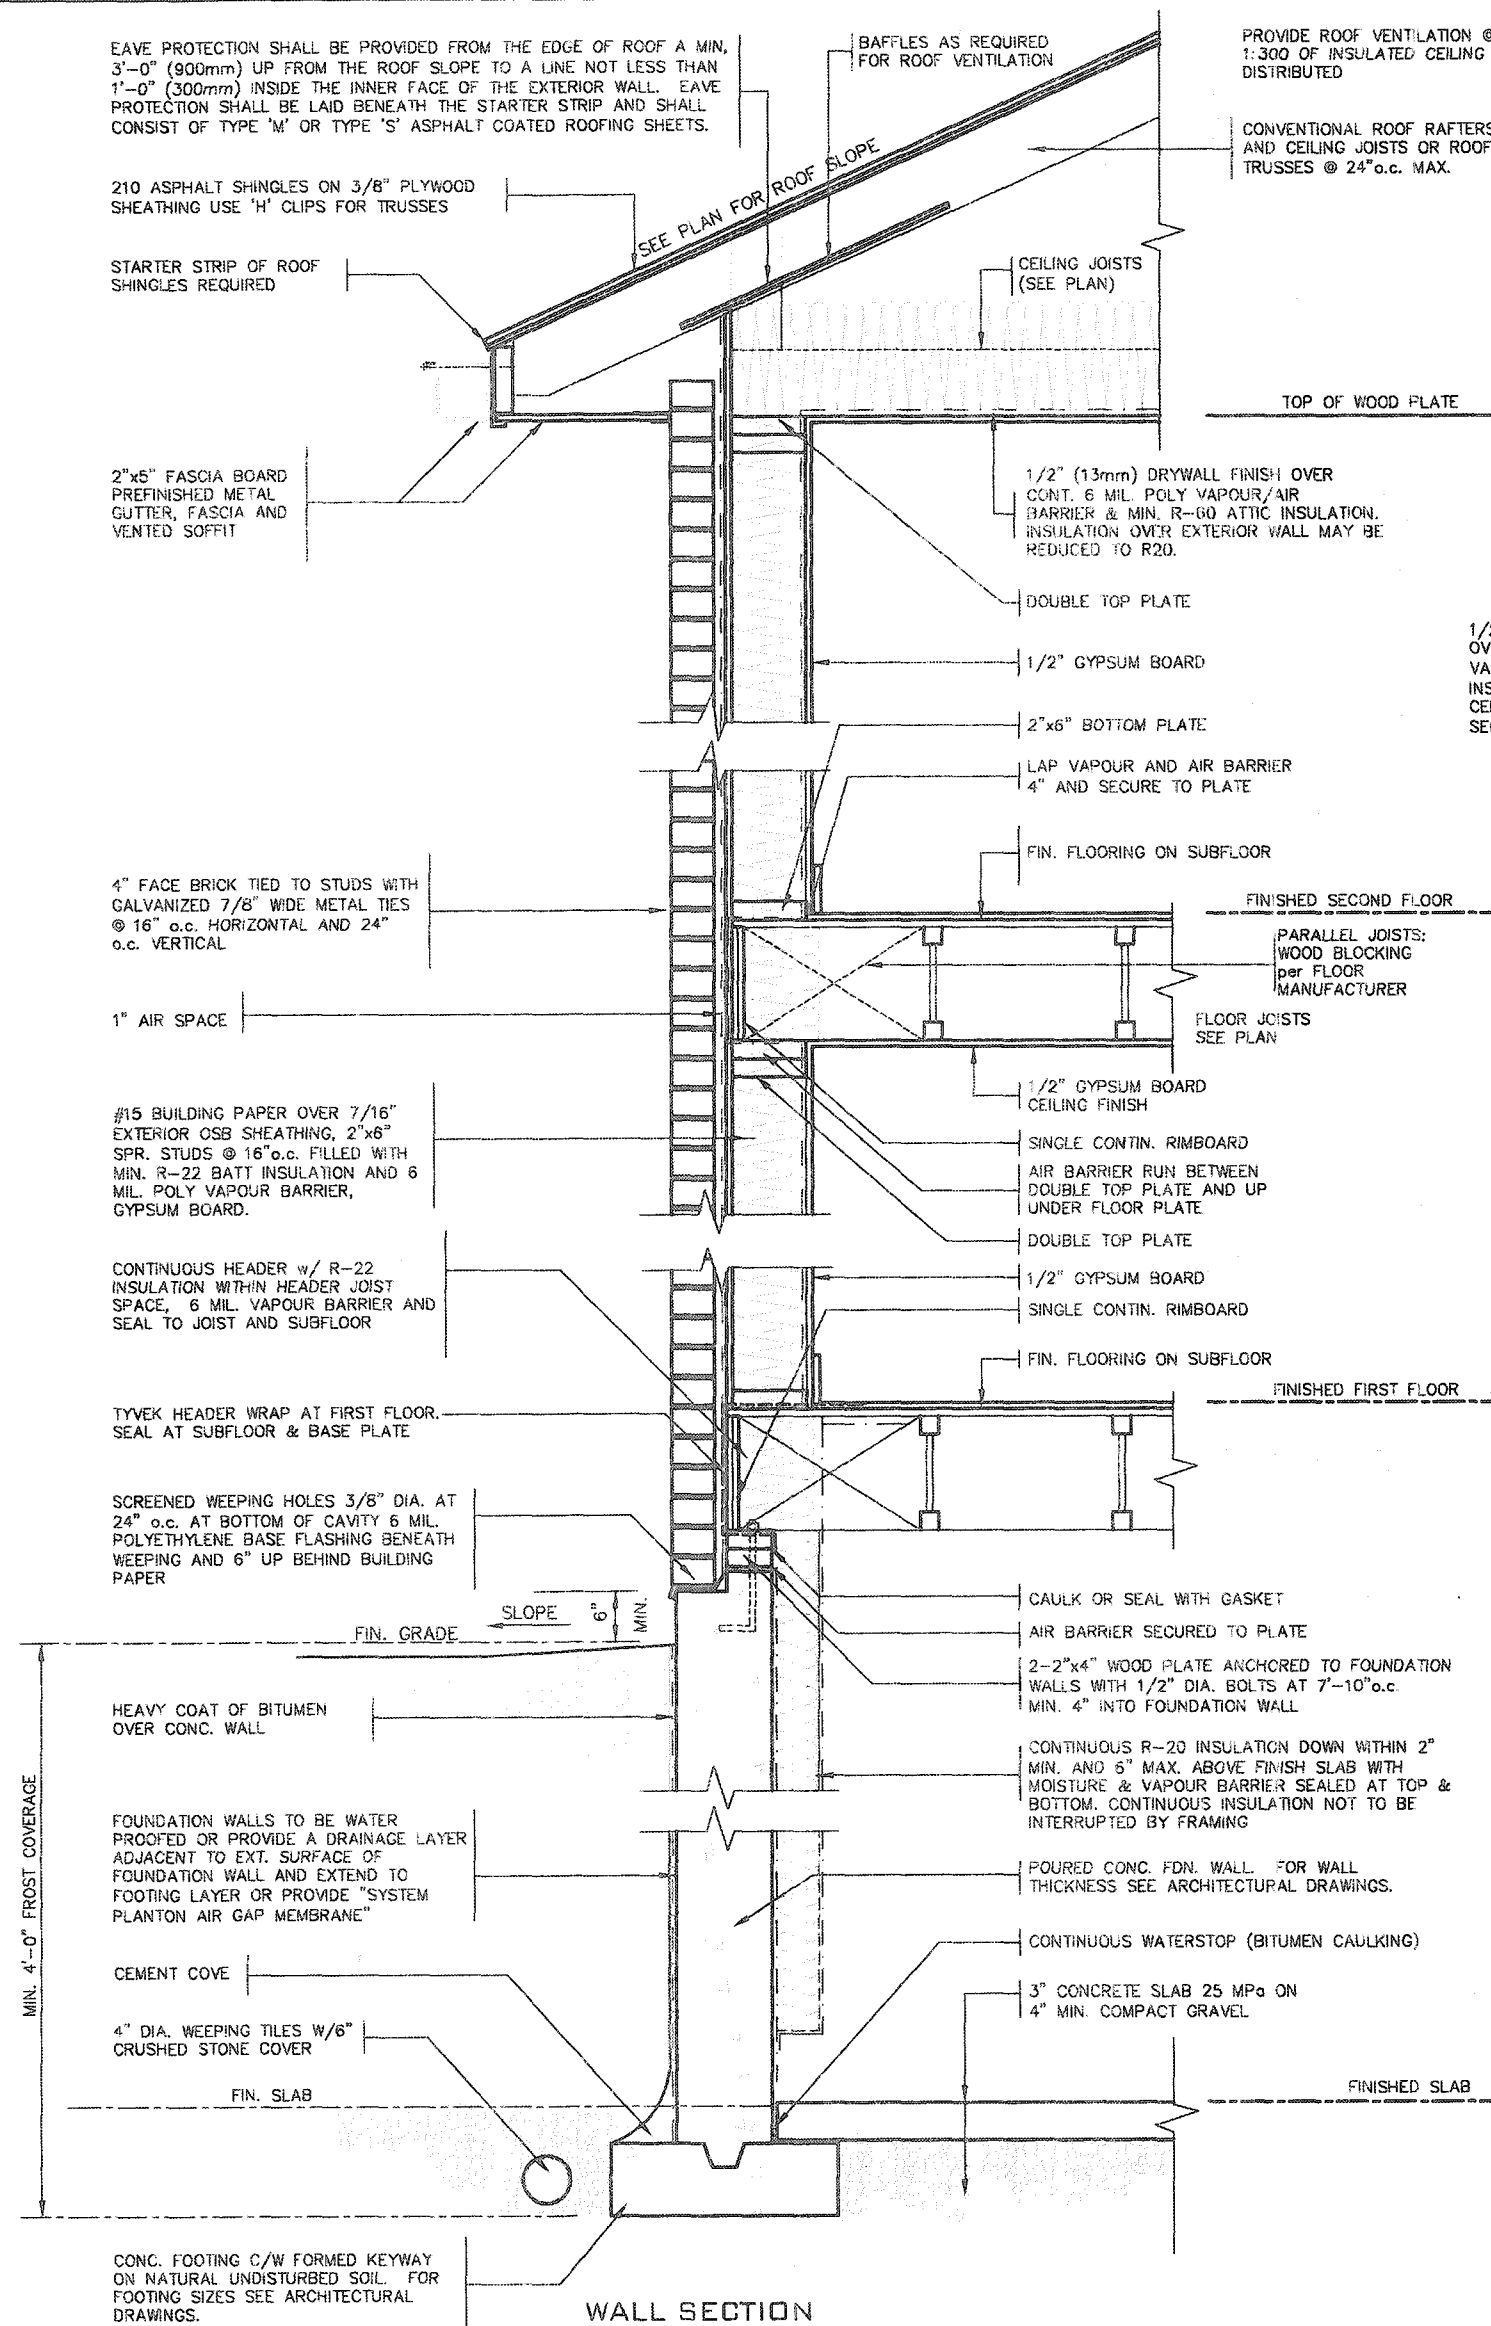

CITY OF HAMILTON
Building Division
Permit No. **187706**
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
SD
FOR CHIEF BUILDING OFFICIAL
DATE **NOV 06 2020**

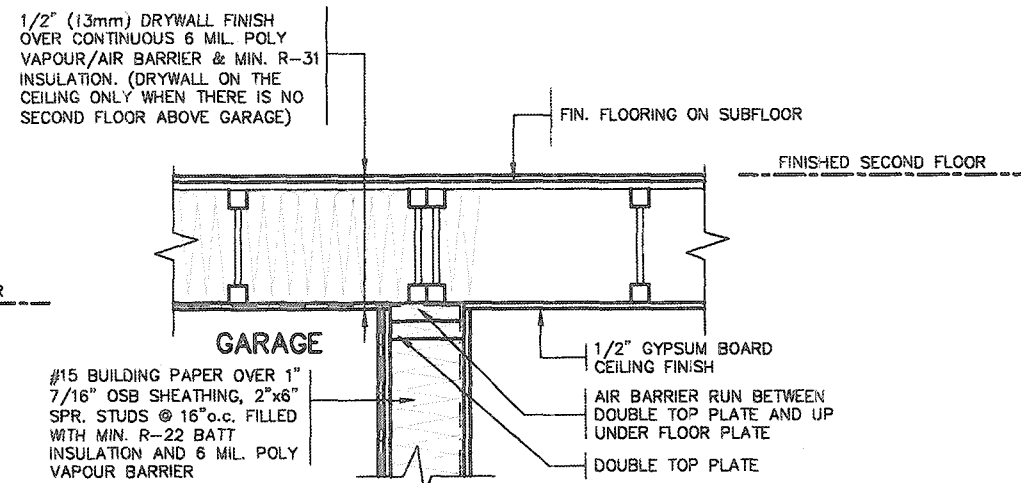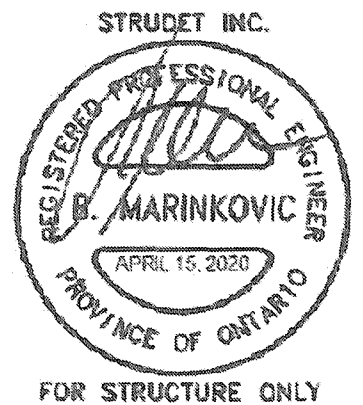


DETAIL FOR CONCRETE VENEER DROPPED GRADE

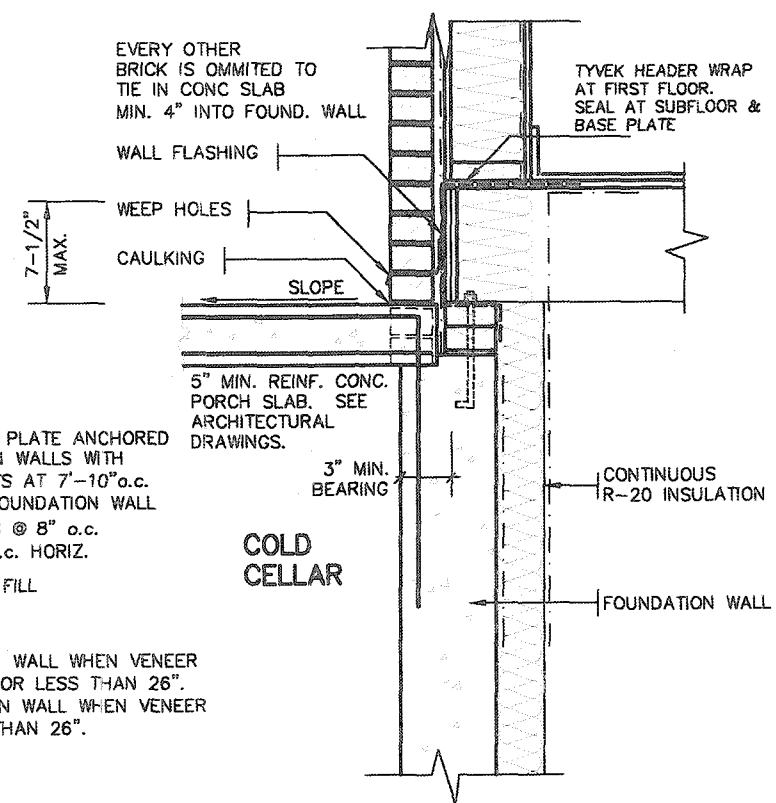


DETAIL FOR COLD CELLAR PORCH SLAB

2012 CODE COMPLIANCE PACKAGE A1

VA3 DESIGN 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 va3design.com		Greenpark. project name: RUSSELL GARDENS PH. 3 municipality: WATERDOWN date: APRIL 2020 drawn by: GW checked by: Not to Scale title: 2"x6" BRICK VENEER SECTIONS drawing no.: 19014-GP-STD_DETAILS_A1		SINGLES project no.: 19014 drawing no.: 3
The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. qualification information: Richard Vink 24488 BCIN name: Richard Vink registration information: VA3 Design Inc. 42658 Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.		1 ISSUED FOR PERMIT no. description: APR 13/20 GW date by		

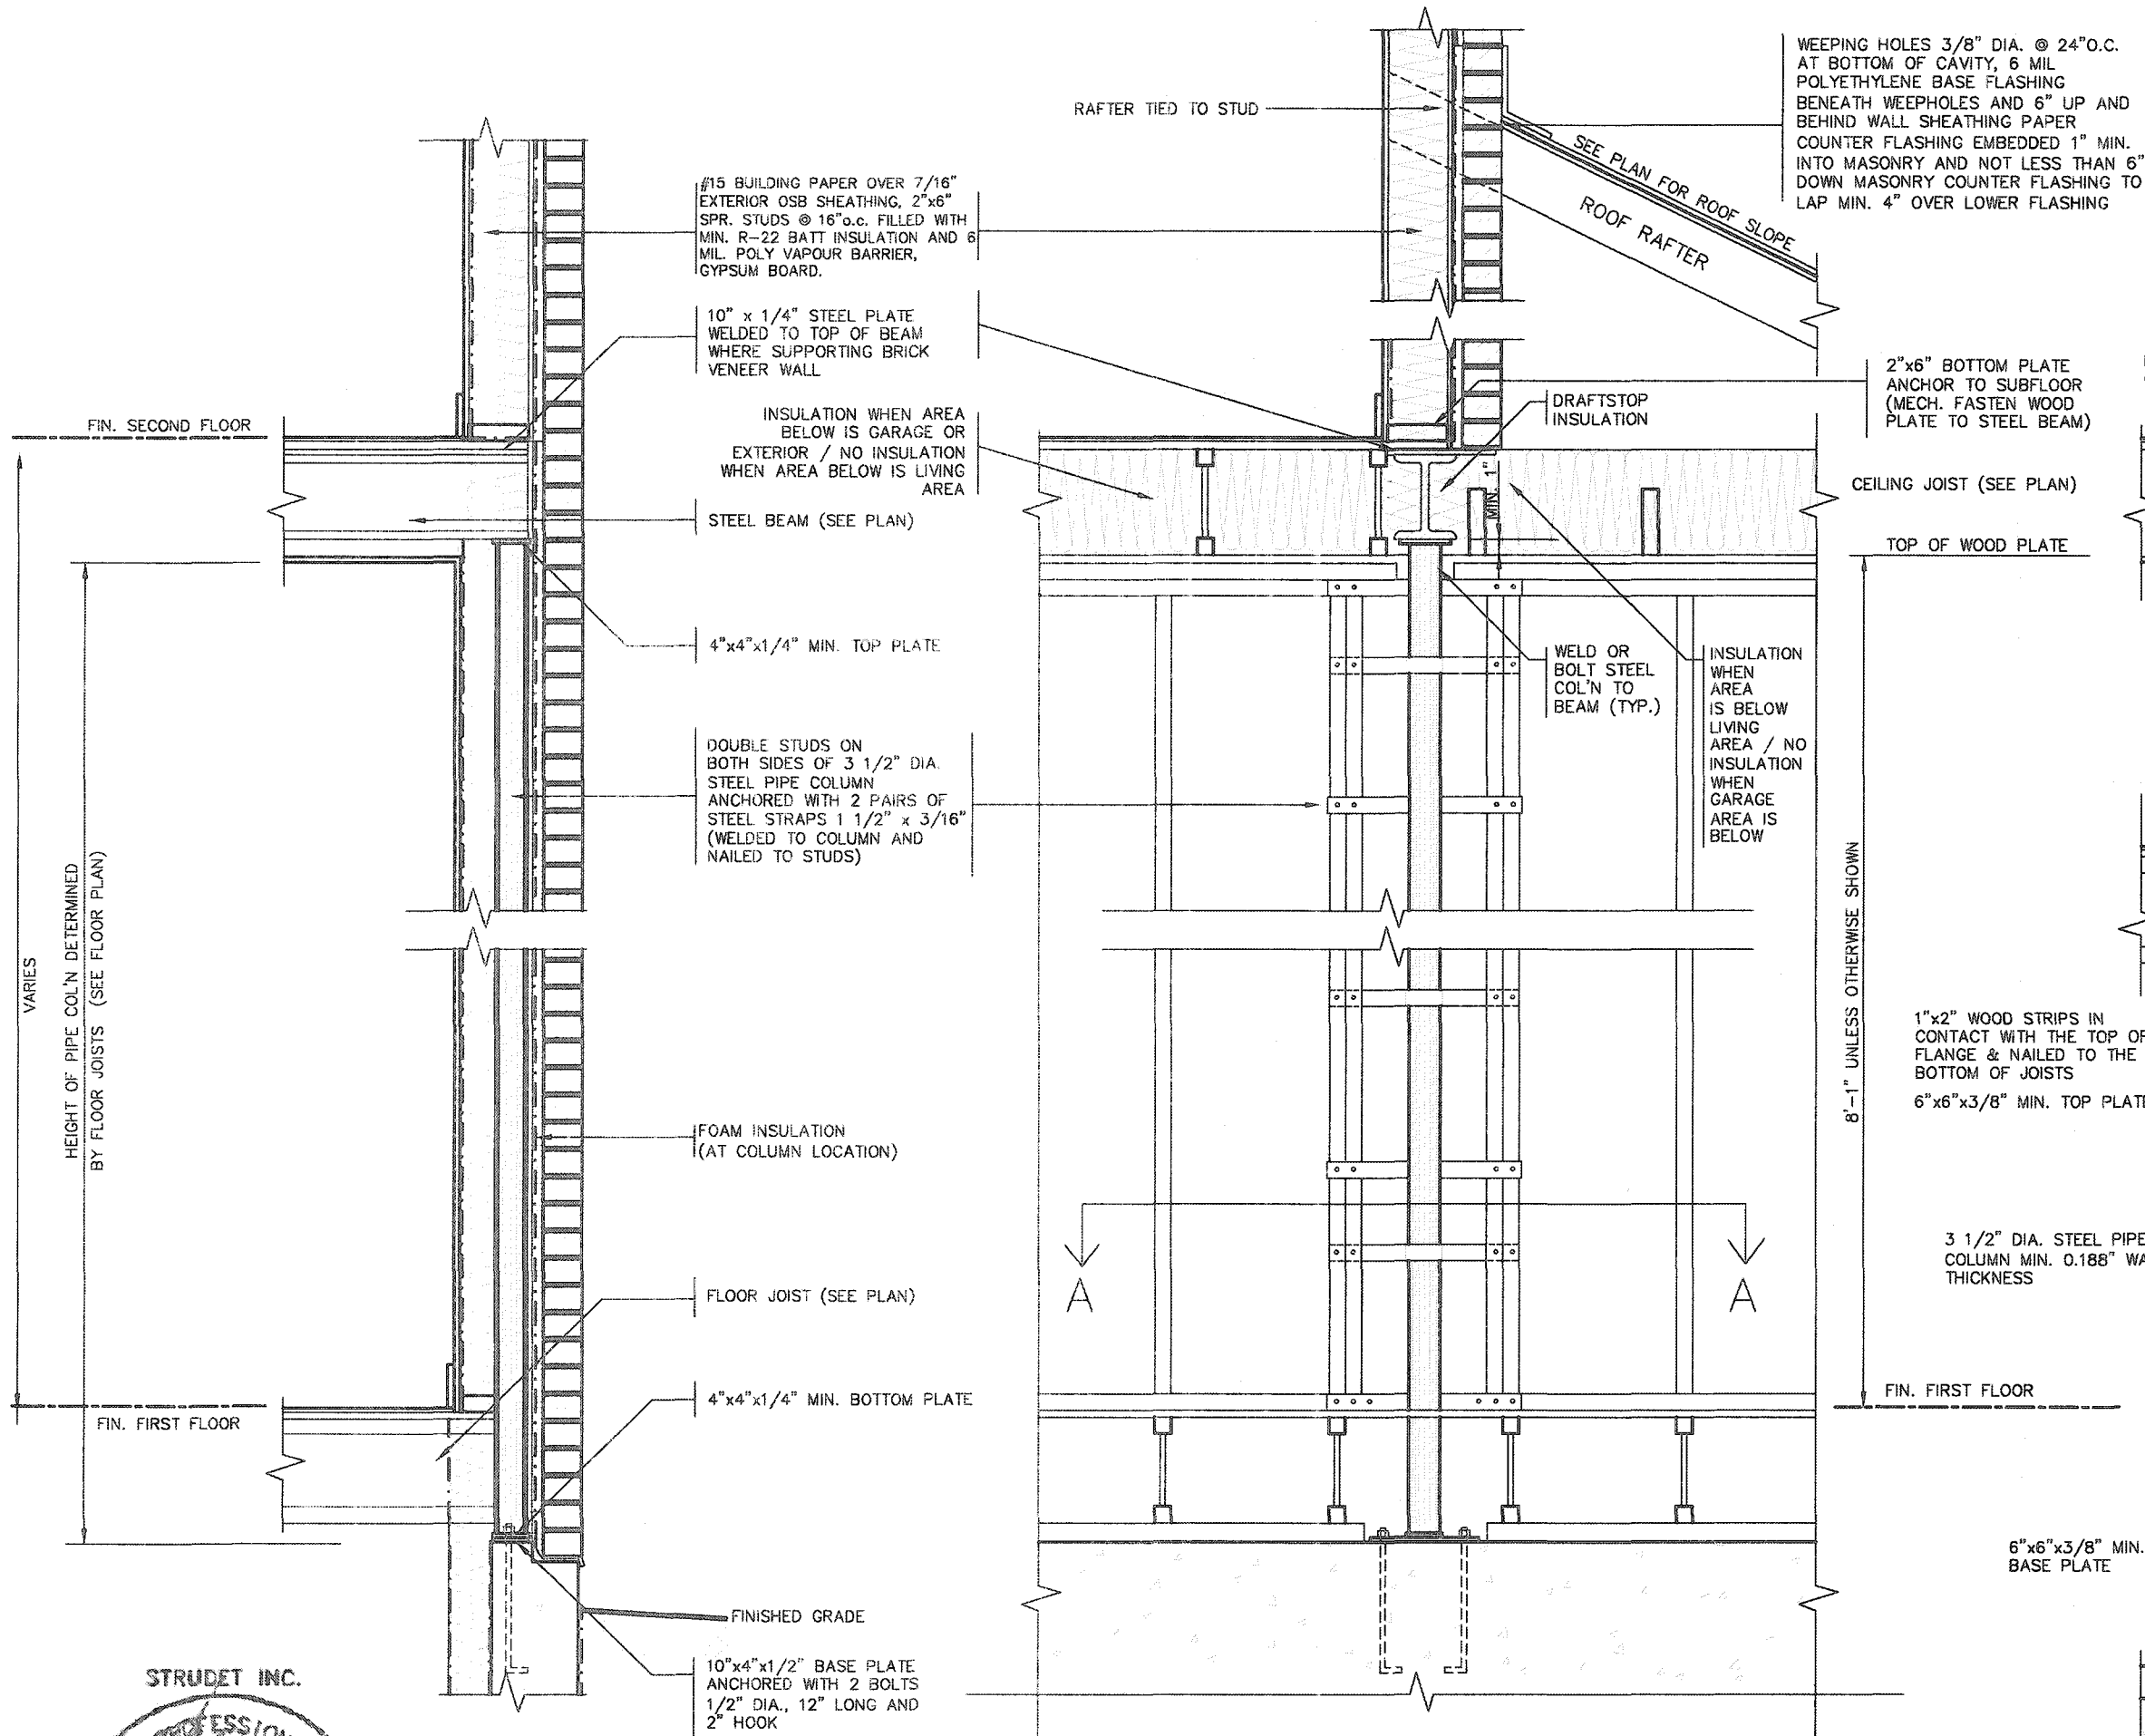

SECTION THROUGH STEEL BEAM SUPPORTING MASONRY & BEARING STUD PARTITION

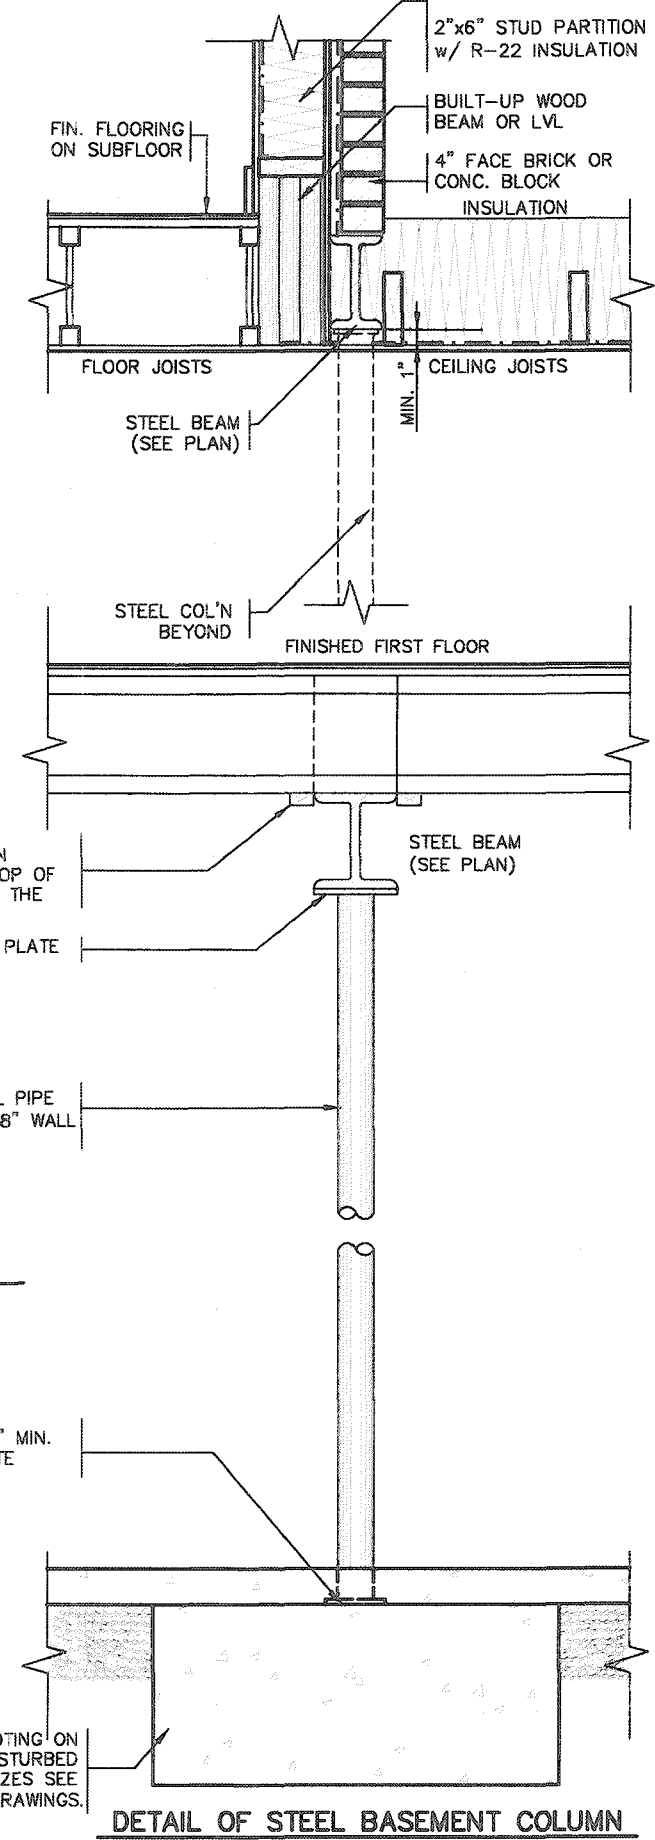

SECTION

CITY OF HAMILTON
Building Division


Permit No. **187706**

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE


THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by
SD
FOR CHIEF BUILDING OFFICIAL

NOV 8 2020

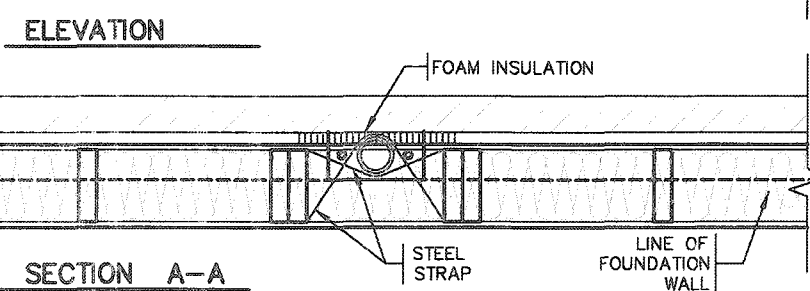

2012 CODE COMPLIANCE PACKAGE A1

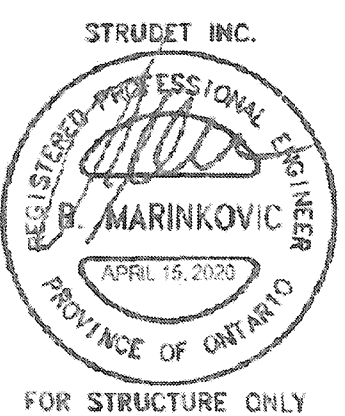

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department

OCT 06 2020

REC'D BY _____ DATE _____


REF'D TO _____ DATE _____

9					
8					
7					
6					
5					
4					
3					
2					
1	ISSUED FOR PERMIT.	APR 13/20	GW		
NO.	description	date	by		

**VAS3
DESIGN**

255 Consumers Rd Suite 120
Toronto ON M2J 1R4
t 416.630.2255 f 416.630.4782
vas3design.com

Greenpark		SINGLES	
project name RUSSELL GARDENS PH. 3	municipality WATERDOWN	project no. 19014	
date APRIL 2020	checked by GW	scale As Shown	drawing no. 4
STEEL COLUMN DETAILS		19014-GP-STD_DETAILS_A1	



3'-6" HIGH WOOD RAILING IF DECK
FLOOR IS MORE THAN 5'-11" ABOVE
GRADE AND 3'-0" HIGH WOOD RAILING
IF DECK IS LESS THAN 5'-11" ABOVE
GRADE

MAX. 4" OPENING BETWEEN PICKETS

5/4 x 6 PRESSURE TREATED
DECKING WITH 1/4" GAP

WB1 RIM JOISTS
(PRESSURE TREATED)

GUARDS FOR STAIRS SHALL NOT BE LESS THAN 2'-11" HIGH MEASURED VERTICALLY FROM A LINE DRAWN THROUGH THE OUTSIDE EDGES OF THE STAIR NOSINGS

7/8" MIN.
7/8" MAX.

2" x 4" WOOD
BLOCKING @ 4'-0"
O.C. MIN. BETWEEN
STRINGERS

2" x 12" STRINGER

PRECAST CONCRETE
SLAB

(CORROSION RESISTANT)
SIMPSON STRONG-TIE COLUMN
BASE. 1/2" DIA. ANCHOR
BOLT.

12" CONC. PIER

WOOD DECK SECTION WITH BRICK VENEER


SCALE: 1/2"=1'-0"





CANTILEVERED PICKET SCREWED TO RIM JOIST AND DECK

GUARD PARALLEL
TO FLOOR JOISTS


SCALE: 1" = 1'-0"

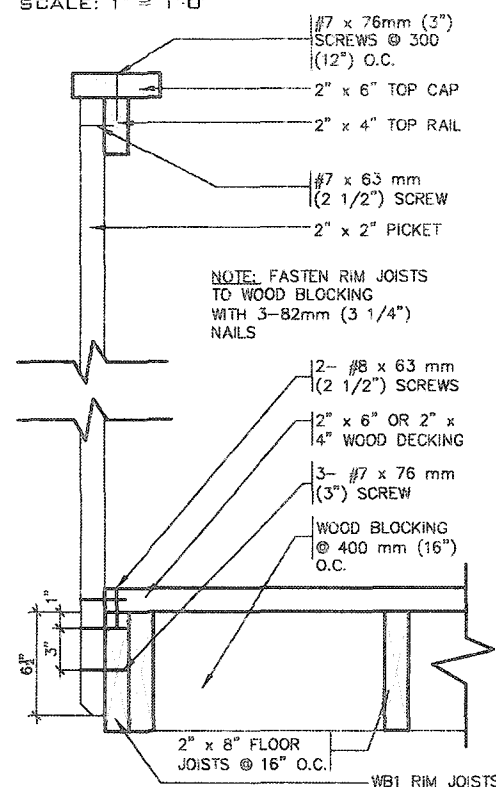

SCALE: 1" = 1'-0"

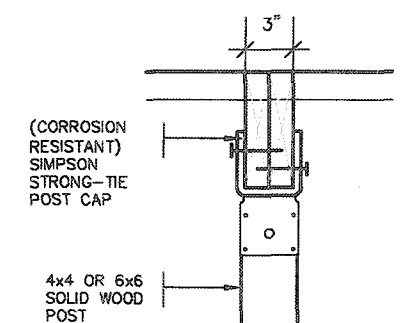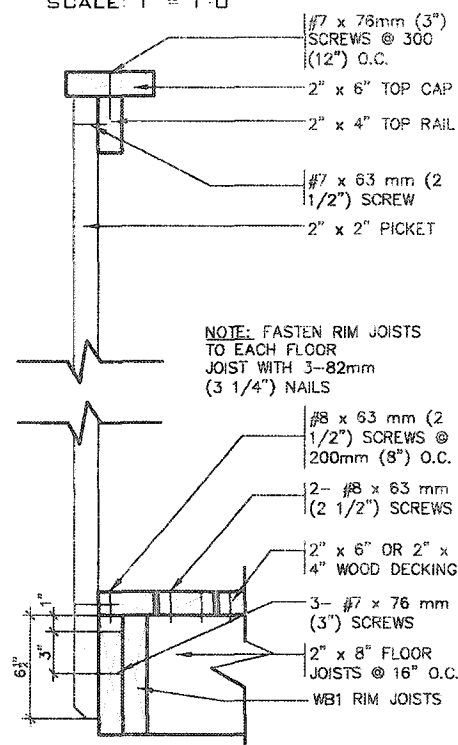


DETAIL 2 -
BEAM-TO-POST
SCALE: 1" = 1'-0"

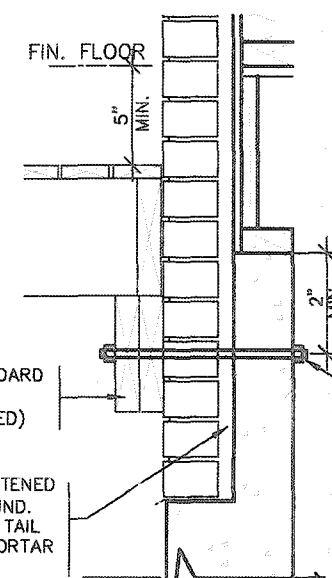

1/2" Ø BOLTS @
24" O/C ACROSS
DECK

No Attachment
to OR Threat
BRICK IS
PERMITTED

DETAIL 3
STEEL ANGLE
SCALE: 1" = 1'-0"

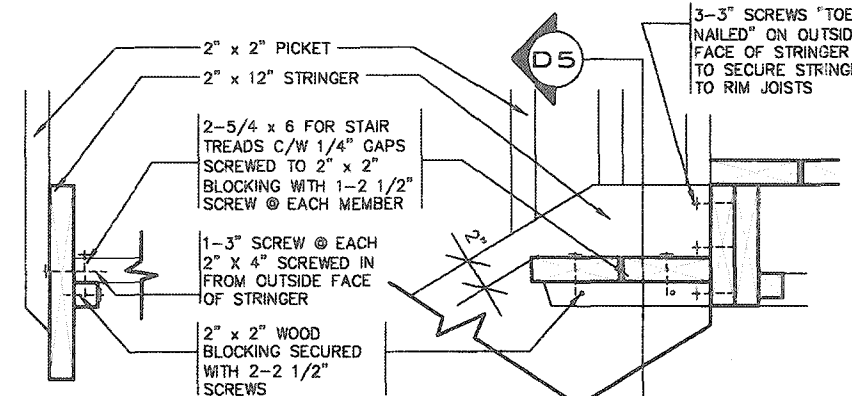

DETAIL 5
SECTION THROUGH
STAIR STRINGER
SCALE: 1" = 1'-0"

DETAIL 4
SECTION @ TREAD AND
STRINGER SECUREMENT
SCALE: 1" = 1'-0"

GENERAL NOTES

1. BRICK TO HAVE COMPRESSIVE STRENGTH OG 15mPa (2200 p.s.i) MIN.UNITS TO BE LAID WITH FULL LEAD AND BED JOINTS.
2. MORTAR TO BE TYPE 'S' WITH JOINT THICKNESS OF 10mm (3/8") MIN. AND 20mm (3/4") MAX.
3. THE DECK HAS BEEN DESIGNED TO SAFELY SUPPORT A SUPERIMPOSED LOAD OF 1.9kPa. [40psf].
4. ALL NAILS AND SCREWS TO BE GALVANIZED.
5. WOOD FOR CANTILEVERED PICKETS SHALL BE DOUGLAS FIR-LARCH, SPRUCE-PINE-FIR, OR HEM-FIR SPECIES.
6. CONCRETE SHALL HAVE COMPRESSIVE STRENGTH OF 20MPa. AT 28 DAYS AND 5-8% AIR ENTRAINED.
7. FOOTING TO BE PLACED ON UNDISTURBED SOIL WITH MINIMUM BEARING PRESSURE OF 150kPa [3130psf].
8. WB1= 2- 2"x8" (PRESSURE TREATED)
WB3= 2- 2"x10" (PRESSURE TREATED)

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department

001 0 6 2020

REC'D BY _____ DATE _____
REF'D TO _____ DATE _____

CITY OF HAMILTON
Building Division

Permit No. 187706

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by

4DC

FOR CHIEF BUILDING OFFICIAL

NOV 19 2002
DATE


STRUDET INC.




FOR STRUCTURE ONLY

2012 CODE
COMPLIANCE PACKAGE A1


[illegible]

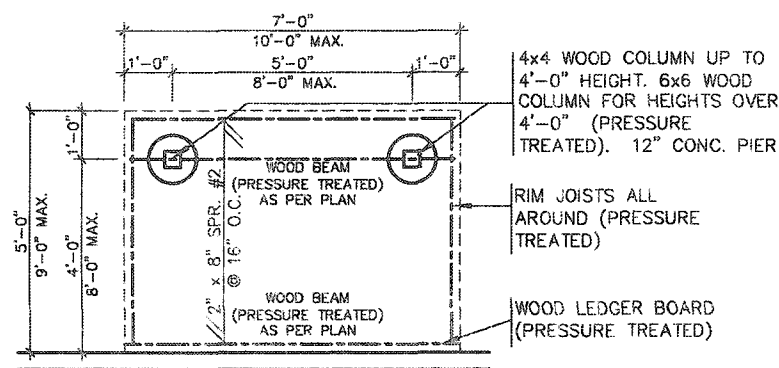


TYPICAL DECK LAYOUT
SCALE: 1/4" = 1'-0"

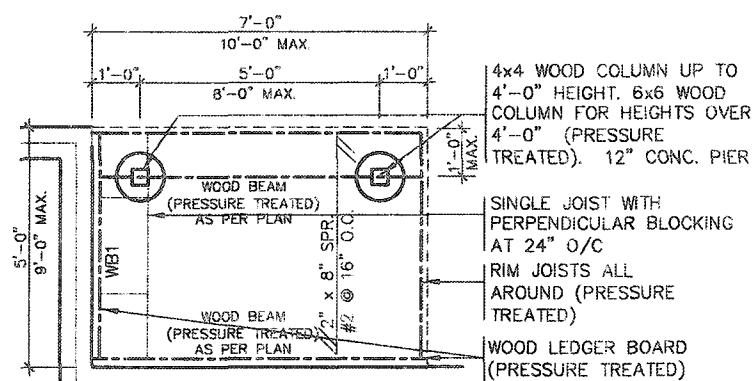

TYPICAL DECK LAYOUT
SCALE: 1/4" = 1'-0"

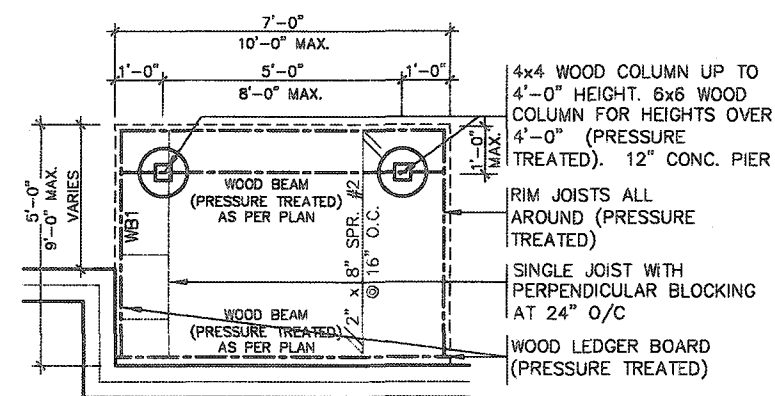

TYPICAL DECK LAYOUT
SCALE: 1/4" = 1'-0"

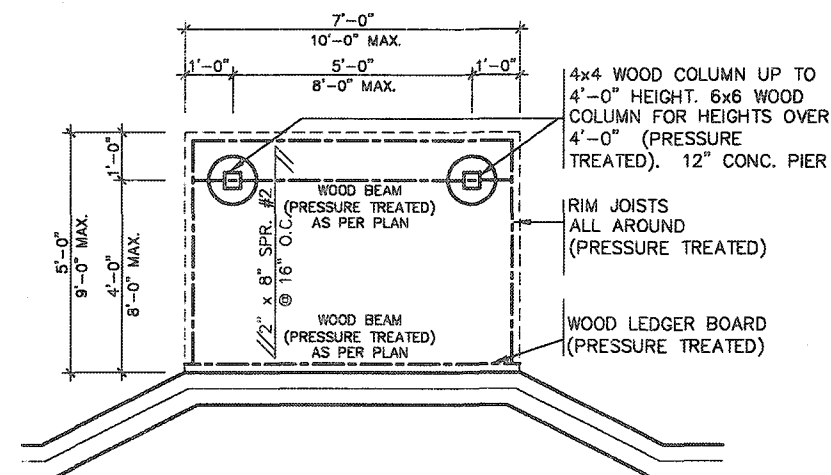

TYPICAL DECK LAYOUT
SCALE: 1/4" = 1'-0"




CITY OF HAMILTON
Building Division

Permit No. 187706

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

SDC NOV 06 2020
FOR CHIEF BUILDING OFFICIAL DATE

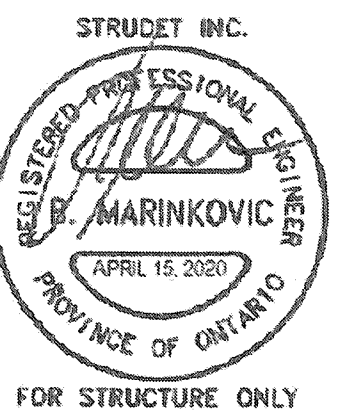

2012 CODE COMPLIANCE PACKAGE A1

9. The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. qualification information Richard Vink 24488 signature BCMA registration information VA3 Design Inc. 42658		VA3 DESIGN 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 va3design.com		Greenpark. project name RUSSELL GARDENS PH. 3 municipality WATERDOWN project no. 19014		SINGLES drawing no. 5-1	
1. ISSUED FOR PERMIT. AFR 13/20 GW no. description date by		2. Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be copied.		3. APRIL 2020 drawn by GW checked by As Shown scale 19014-GP-STD_DETAILS_A1		4. WOOD DECK PLANS file name 19014-GP-STD_DETAILS_A1	

(CORROSION RESISTANT) SIMPSON STRONG-TIE POST CAP

6x6 SOLID WOOD POST (PRESSURE TREATED)

DETAIL 2 - BEAM-TO-POST
SCALE: 1" = 1'-0"

2x2 PICKETS CHAMFERED AT BOTTOM WITH 2x6 TOP CAP AND 2x4 TOP RAIL (REFER TO DETAIL 1)

3'-6" HIGH WOOD RAILING IF DECK FLOOR IS MORE THAN 5'-11" ABOVE GRADE AND 3'-0" HIGH WOOD RAILING IF DECK IS LESS THAN 5'-11" ABOVE GRADE

MAX. 4" OPENING BETWEEN PICKETS

5/4x6 (PRESSURE TREATED) DECKING WITH 1/4" GAP

DOUBLE RIM JOISTS (PRESSURE TREATED)

WOOD BEAM AS PER PLAN (PRESSURE TREATED)

(CORROSION RESISTANT) SIMPSON STRONG-TIE POST CAP

(CORROSION RESISTANT) SIMPSON STRONG-TIE COLUMN BASE, 1/2" DIA. ANCHOR BOLT.

GRADE

12" CONC. PIER

4x4 SOLD BRACING (PRESSURE TREATED), 24" LONG AT 45° FOR COLUMNS OVER 7'-0" IN HEIGHT

TYPICAL BRICK VENEER WALL CONSTRUCTION

CONC. FOUNDATION

CONC. FOOTING

FINISH FLOOR

DOUBLE RIM FOR DECKING SUPPORT

NAIL BEAM TO STUDS BOTH SIDES

DOUBLE STUD BELOW BEAM WITH FULL HEIGHT SINGLE STUD ON EACH SIDE.

DETAIL 3 - BEAM-TO-STUD WALL
SCALE: 1" = 1'-0"

DECK SECTION WITH BRICK VENEER
SCALE: 1/2" = 1'-0"

DETAIL 1
CANTILEVERED PICKET SCREWED TO RIM JOIST AND DECK
GUARD PARALLEL TO FLOOR JOISTS
SCALE: 1" = 1'-0"

#7 x 76mm (3") SCREWS @ 300 (12") O.C.

2" x 6" TOP CAP

2" x 4" TOP RAIL

#7 x 63 mm (2 1/2") SCREW

2" x 2" PICKET

NOTE: FASTEN DOUBLE RIM JOISTS TO EACH FLOOR JOIST WITH 3-82mm (3 1/4") NAILS.

2- #8 x 63 mm (2 1/2") SCREWS

5/4 x 6 WOOD DECKING

3- #7 x 76 mm (3") SCREW

WOOD BLOCKING @ 400 mm (16") O.C.

DECK JOISTS @ 16" O.C.

DOUBLE RIM JOISTS

GUARD PERPENDICULAR TO FLOOR JOISTS
SCALE: 1" = 1'-0"

#7 x 76mm (3") SCREWS @ 300 (12") O.C.

2" x 6" TOP CAP

2" x 4" TOP RAIL

#7 x 63 mm (2 1/2") SCREW

2" x 2" PICKET

NOTE: FASTEN DOUBLE RIM JOISTS TO EACH FLOOR JOIST WITH 3-82mm (3 1/4") NAILS.

2- #8 x 63 mm (2 1/2") SCREWS @ 200mm (8") O.C.

2- #8 x 63 mm (2 1/2") SCREWS

5/4 x 6 WOOD DECKING

3- #7 x 76 mm (3") SCREWS

DECK JOISTS @ 16" O.C.

DOUBLE RIM JOISTS

GENERAL NOTES

- BRICK TO HAVE COMPRESSIVE STRENGTH OG 15mPa (2200 p.s.i.) MIN. UNITS TO BE LAID WITH FULL HEAD AND BED JOINTS.
- MORTAR TO BE TYPE 'S' WITH JOINT THICKNESS OF 10mm (3/8") MIN. AND 20mm (3/4") MAX.
- THE DECK HAS BEEN DESIGNED TO SAFELY SUPPORT A SUPERIMPOSED LOAD OF 1.9kPa. [40psf].
- ALL NAILS AND SCREWS TO BE GALVANIZED.
- WOOD FOR CANTILEVERED PICKETS SHALL BE DOUGLAS FIR-LARCH, SPRUCE-PINE-FIR, OR HEM-FIR SPECIES.
- CONCRETE SHALL HAVE COMPRESSIVE STRENGTH OF 20MPa. AT 28 DAYS AND 5-8% AIR ENTRAINED.
- FOOTING TO BE PLACED ON UNDISTURBED SOIL WITH MINIMUM BEARING PRESSURE OF 150kPa [3130psf].
- WB1= 2- 2"x8" (PRESSURE TREATED)
WB3= 2- 2"x10" (PRESSURE TREATED)



CITY OF HAMILTON
Building Division

Permit No. **187706**

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

ADL NOV 06 2020

FOR CHIEF BUILDING OFFICIAL



2012 CODE COMPLIANCE PACKAGE A1

9					
8					
7					
6					
5					
4					
3					
2					
1	ISSUED FOR PERMIT.	APR 13/20	GW		
no.	description	date	by		

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.

qualification information

Richard Vink 24488 BCN

signature







VA3 Design Inc. 42658

Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.

VA3 DESIGN

255 Consumers Rd Suite 120
Toronto ON M2J 1R4
t 416.630.2255 f 416.630.4782
va3design.com

Greenpark	SINGLES
project name RUSSELL GARDENS PH. 3	manipulated by WATERDOWN
date APRIL 2020	drawing no. 19014
drawn by GW	checked by As Shown
scale As Shown	19014-GP-STD_DETAILS_A1
file name	6

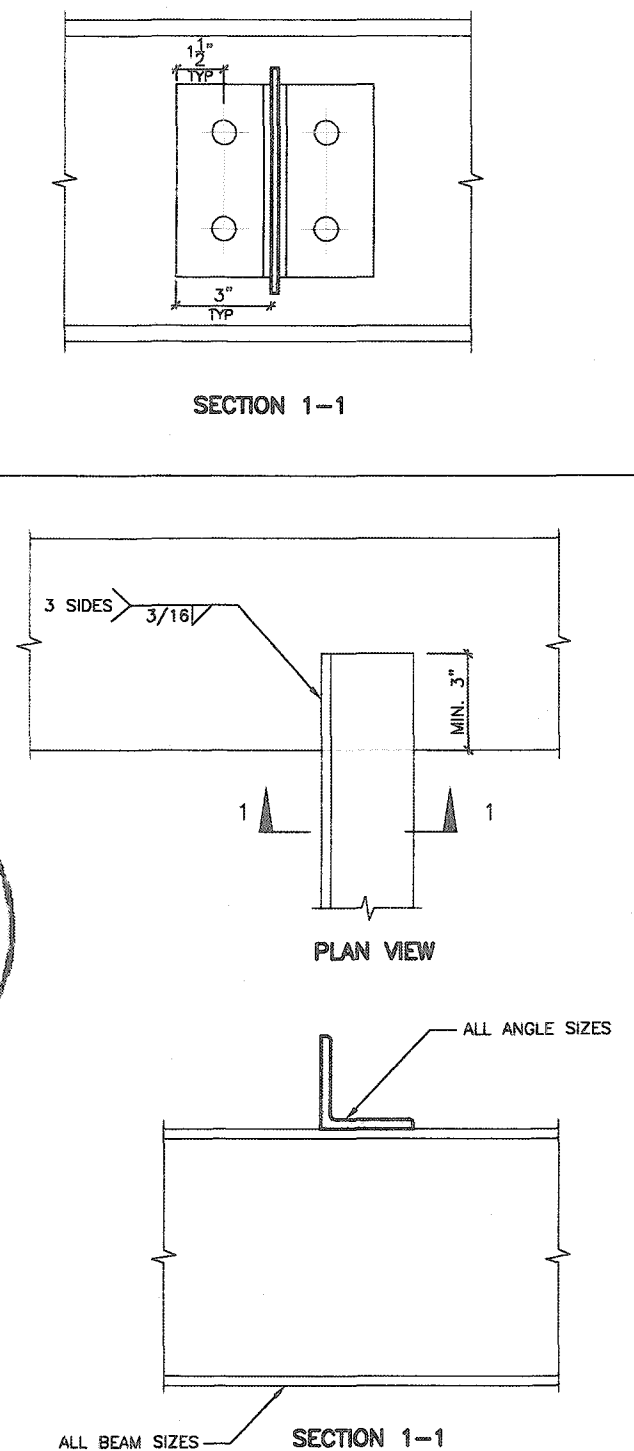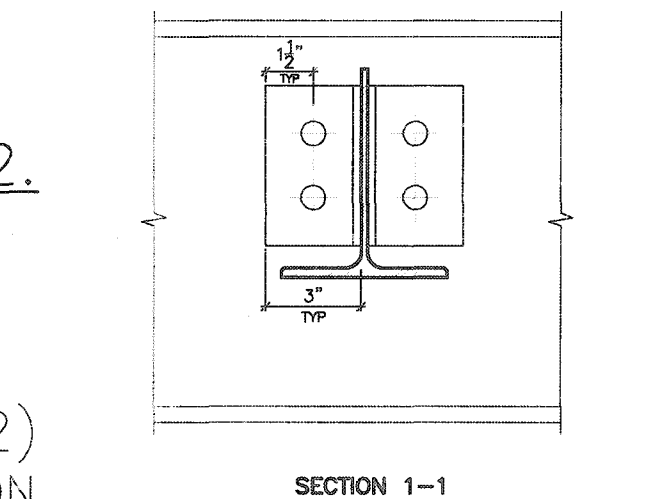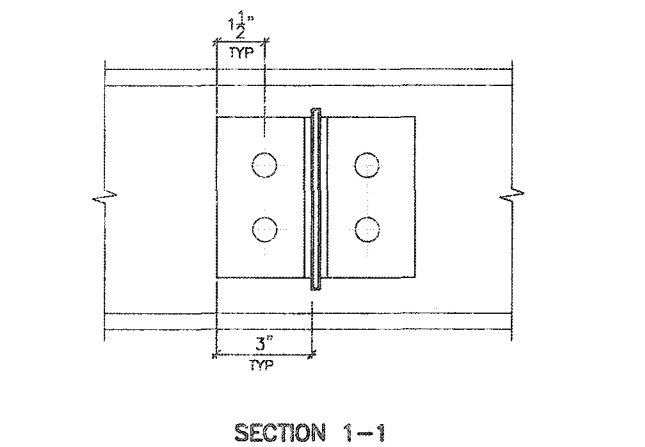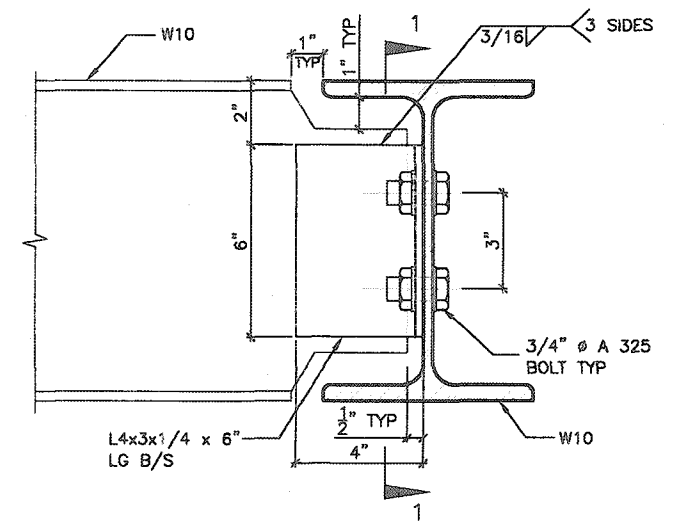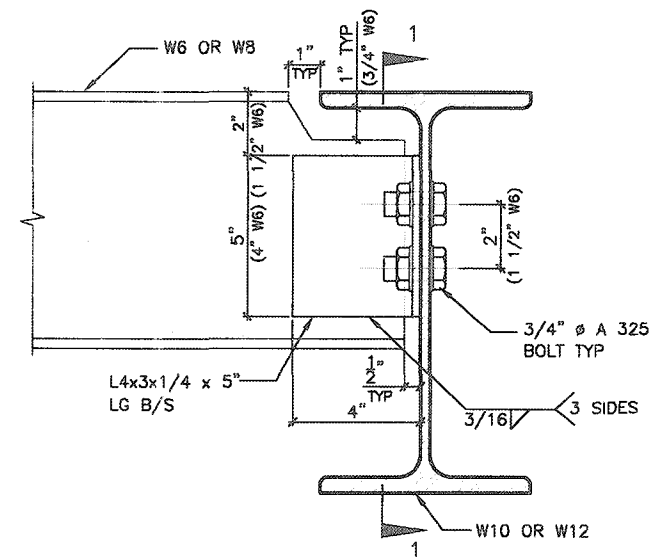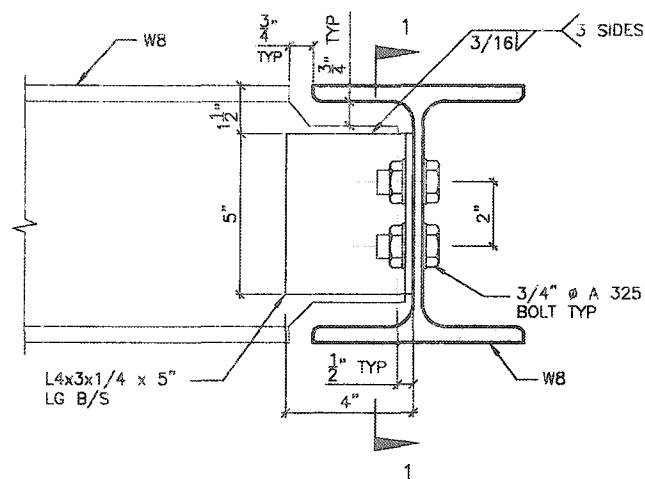

374 W A 325
BOLT TYP

CITY OF HAMILTON
Building Division

187706

W122 permit No.

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAWS

These drawings and/or specifications have been reviewed by

[Signature]

NOV 8 1998

FOR CHIEF BUILDING OFFICIAL DATE

2012 CODE COMPLIANCE PACKAGE

SINGLES


project name	municipality	project no.
RUSSELL GARDENS PH. 3	WATERDOWN	19014

DATE APRIL 2020		STEEL BEAM CONNECTIONS		drawing no.
drawn by GW	checked by -	scale Not to Scale	file name 19014-GP-STD_DETAILS_A1	7


**VA3
DESIGN**
255 Consumers Rd Suite 120
Toronto ON M2J 1R4
t 416.630.2255 f 416.630.4787
va3design.com




9					The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.
8					qualification information
7					Richard Vink 2448
6					name <i>R Vink</i> BC
5					signature
4					registration information
3					VAS Design Inc. 4265
2					
1					Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings not to be scaled.
ISSUED FOR PERMIT.		APR 13/20	GW		
no	description		date	by	



STRUCTURAL REINFORCEMENT FOR GRAB BAR (OBC 9.5.2.3.)
FOR MAIN BATH ONLY

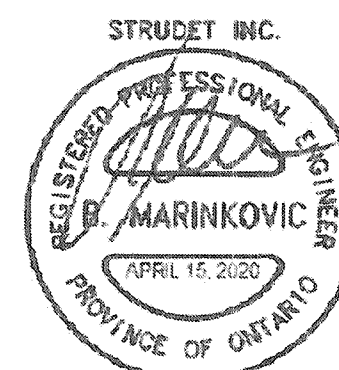

FOR STRUCTURE ONLY

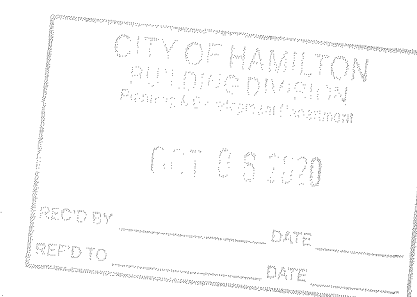

CITY OF HAMILTON
Building Division

Permit No. 187706

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

NOV 06 2020

FOR CHIEF BUILDING OFFICIAL DATE

2012 CODE E PACKAGE

9					The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.	
8					qualification information	
7						
6					Richard Vink	2448
5					name	BC
4					registration information	
3					VA3 Design Inc.	4265
2						
1	ISSUED FOR PERMIT.	APR 13/20	GW		Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.	
	no. description		date by			


**VA3
DESIGN**
255 Consumers Rd Suite
Toronto ON M2J 1R1
t 416.630.2255 f 416.631.
va3design.com

Greenpark

SINGLES

project name RUSSELL GARDENS PH. 3	map/sheet WATERDOWN	project no. 19014
date APRIL 2020	drawing no. 8	
drawn by GW	checked by -	scale Not to Scale
title name STUD WALL REINFORCEMENT		file name 19014-GP-STD_DETAILS_A1

All drawings, specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.

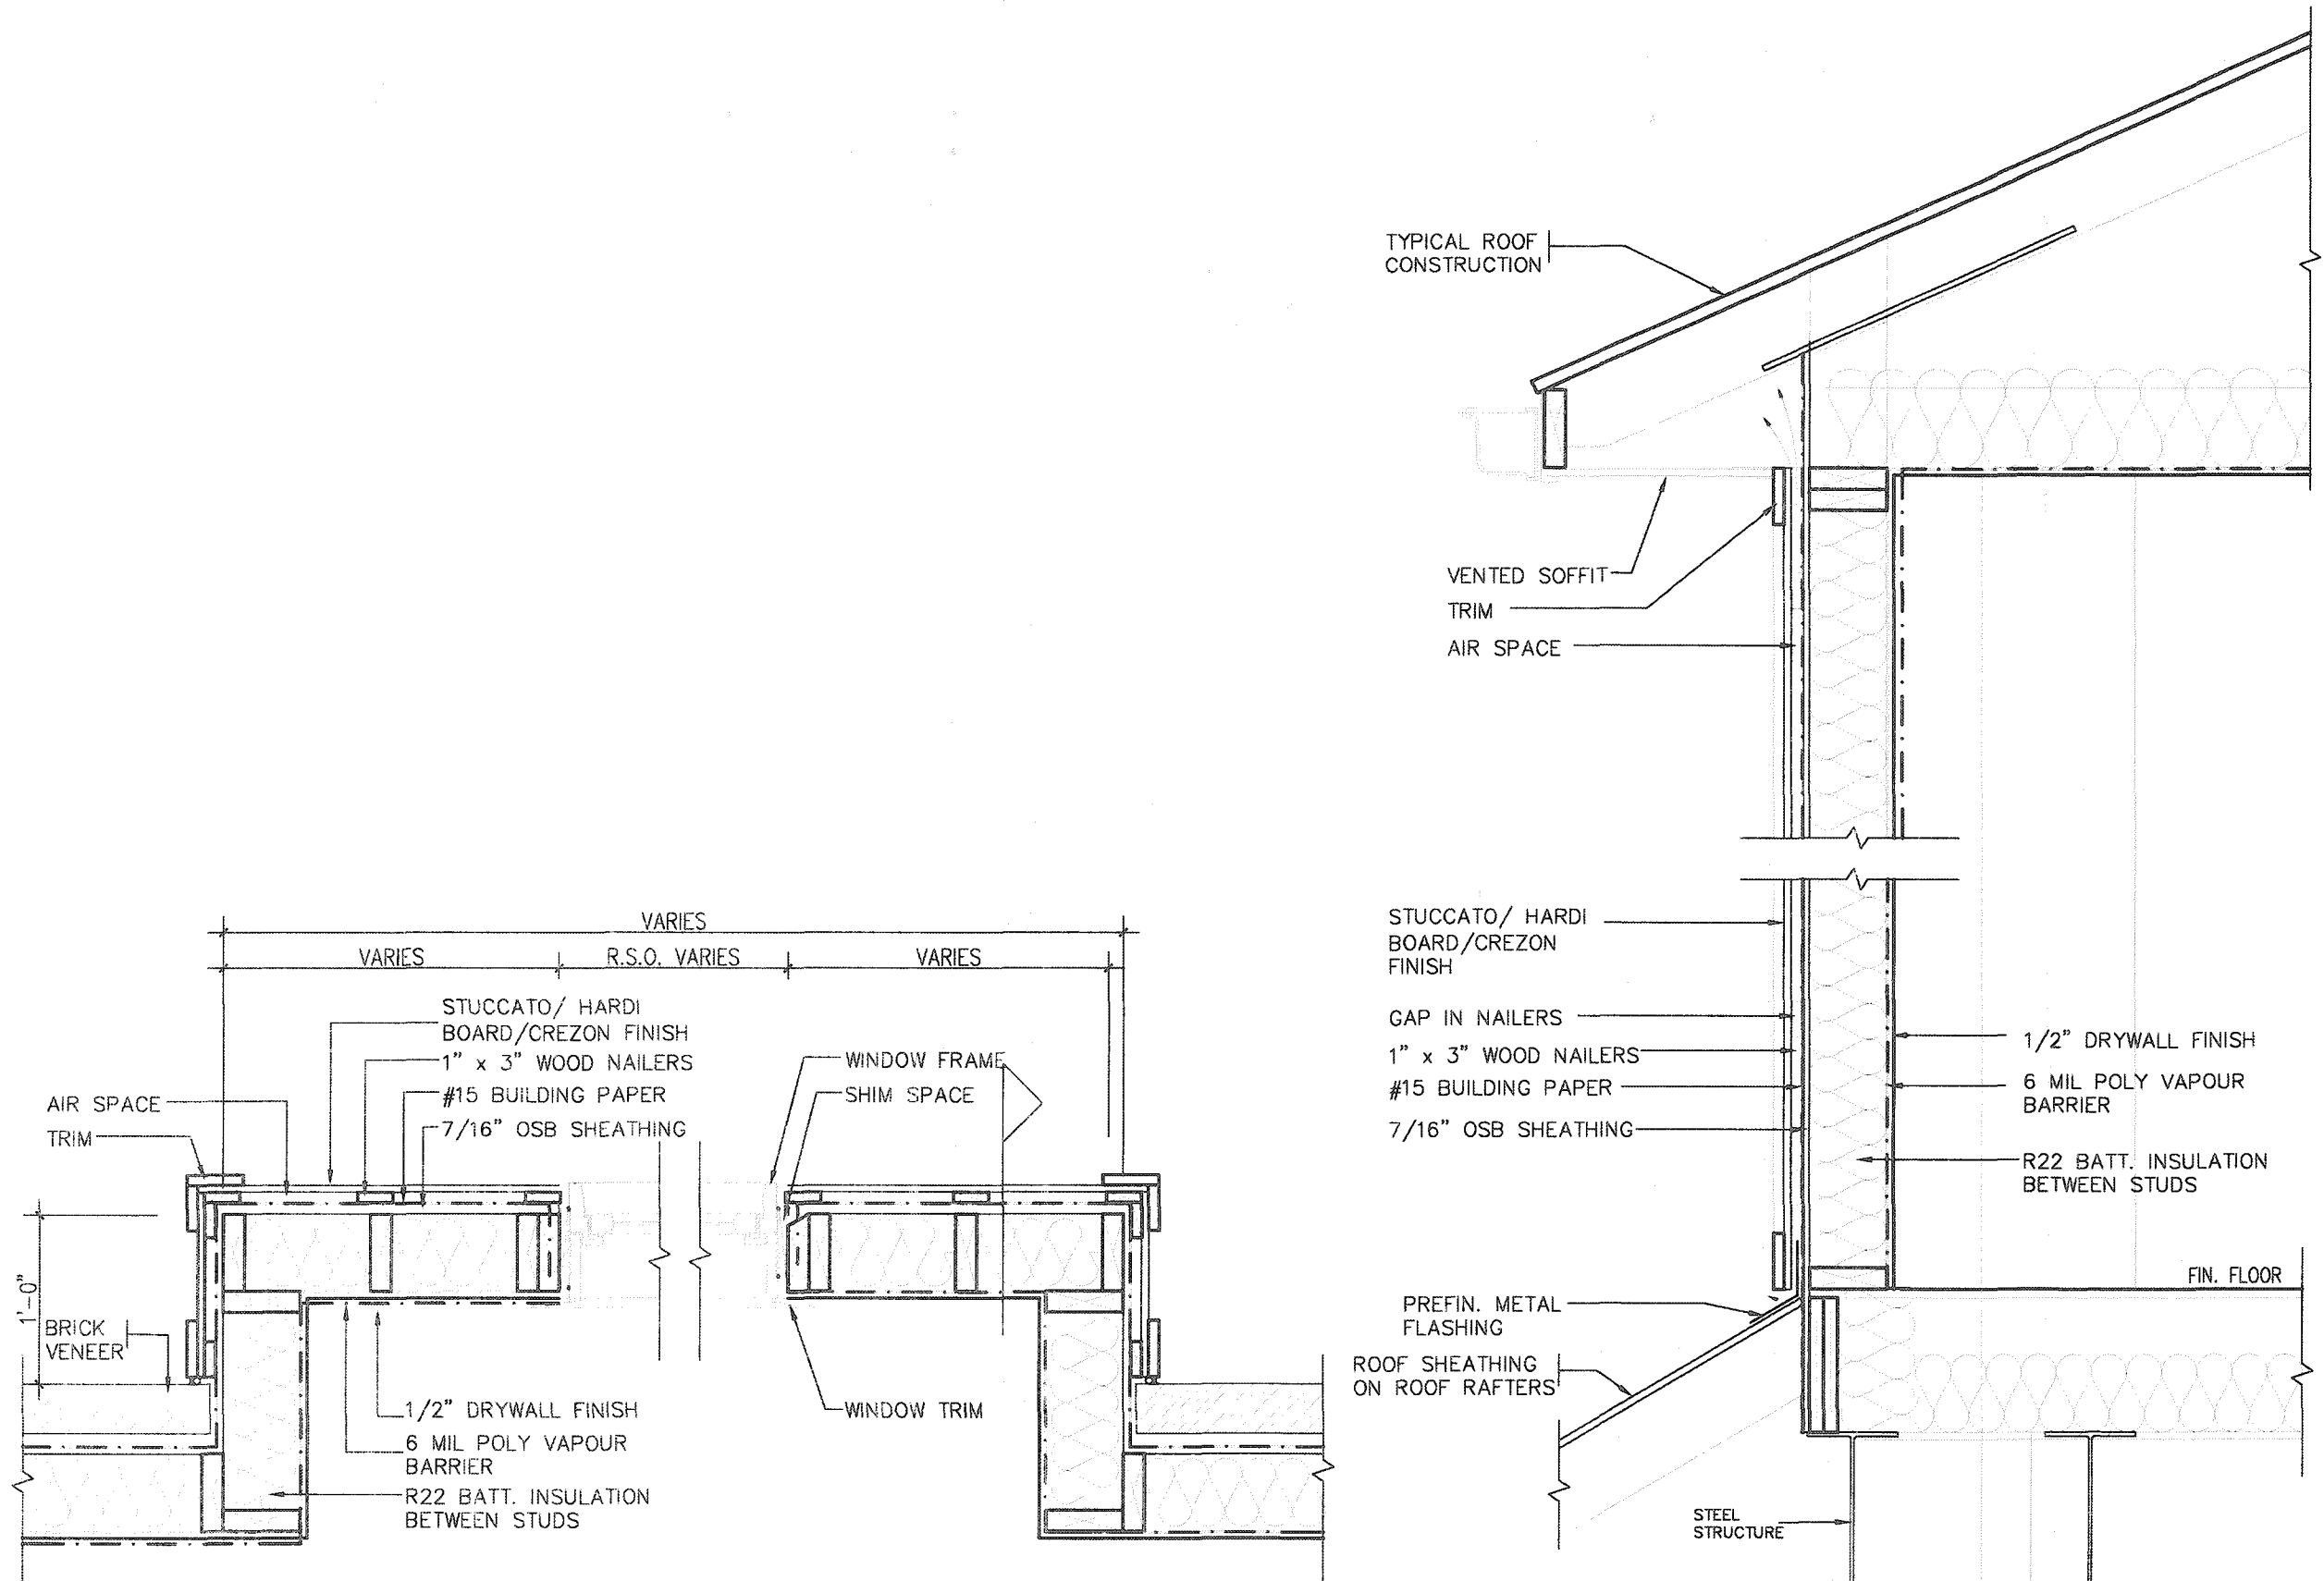

PLAN VIEW

CROSS SECTION

STUCCATO BOARD FINISH CLADDING OR EQUAL (OBC 9.27.)

CITY OF HAMILTON
BUILDING DIVISION
Permit & Development Control Unit

REC'D BY _____ DATE _____
REF'D TO _____ DATE _____







Permit No. **187706**

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by
UDL
FOR CHIEF BUILDING OFFICIAL DATE **APR 15 2020**


**2012 CODE
COMPLIANCE PACKAGE A1**

9																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																				
---	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

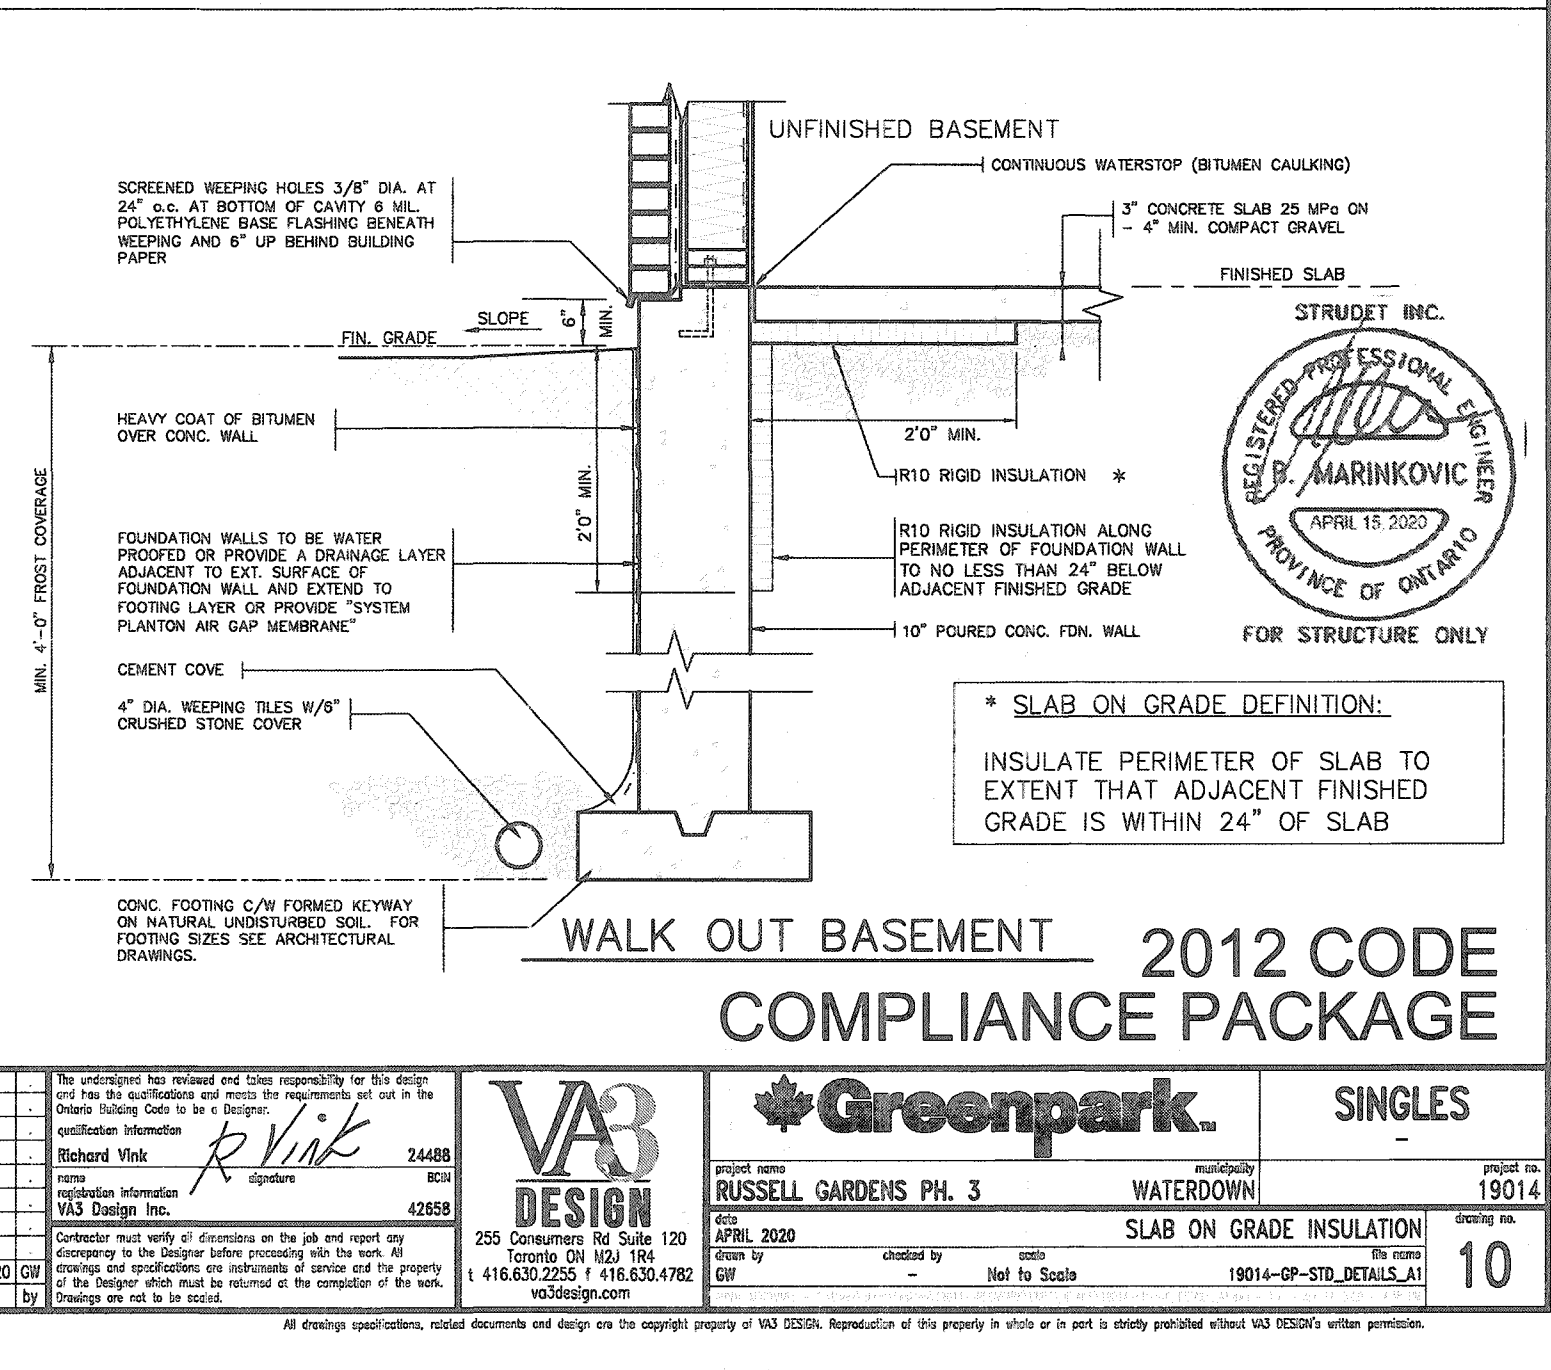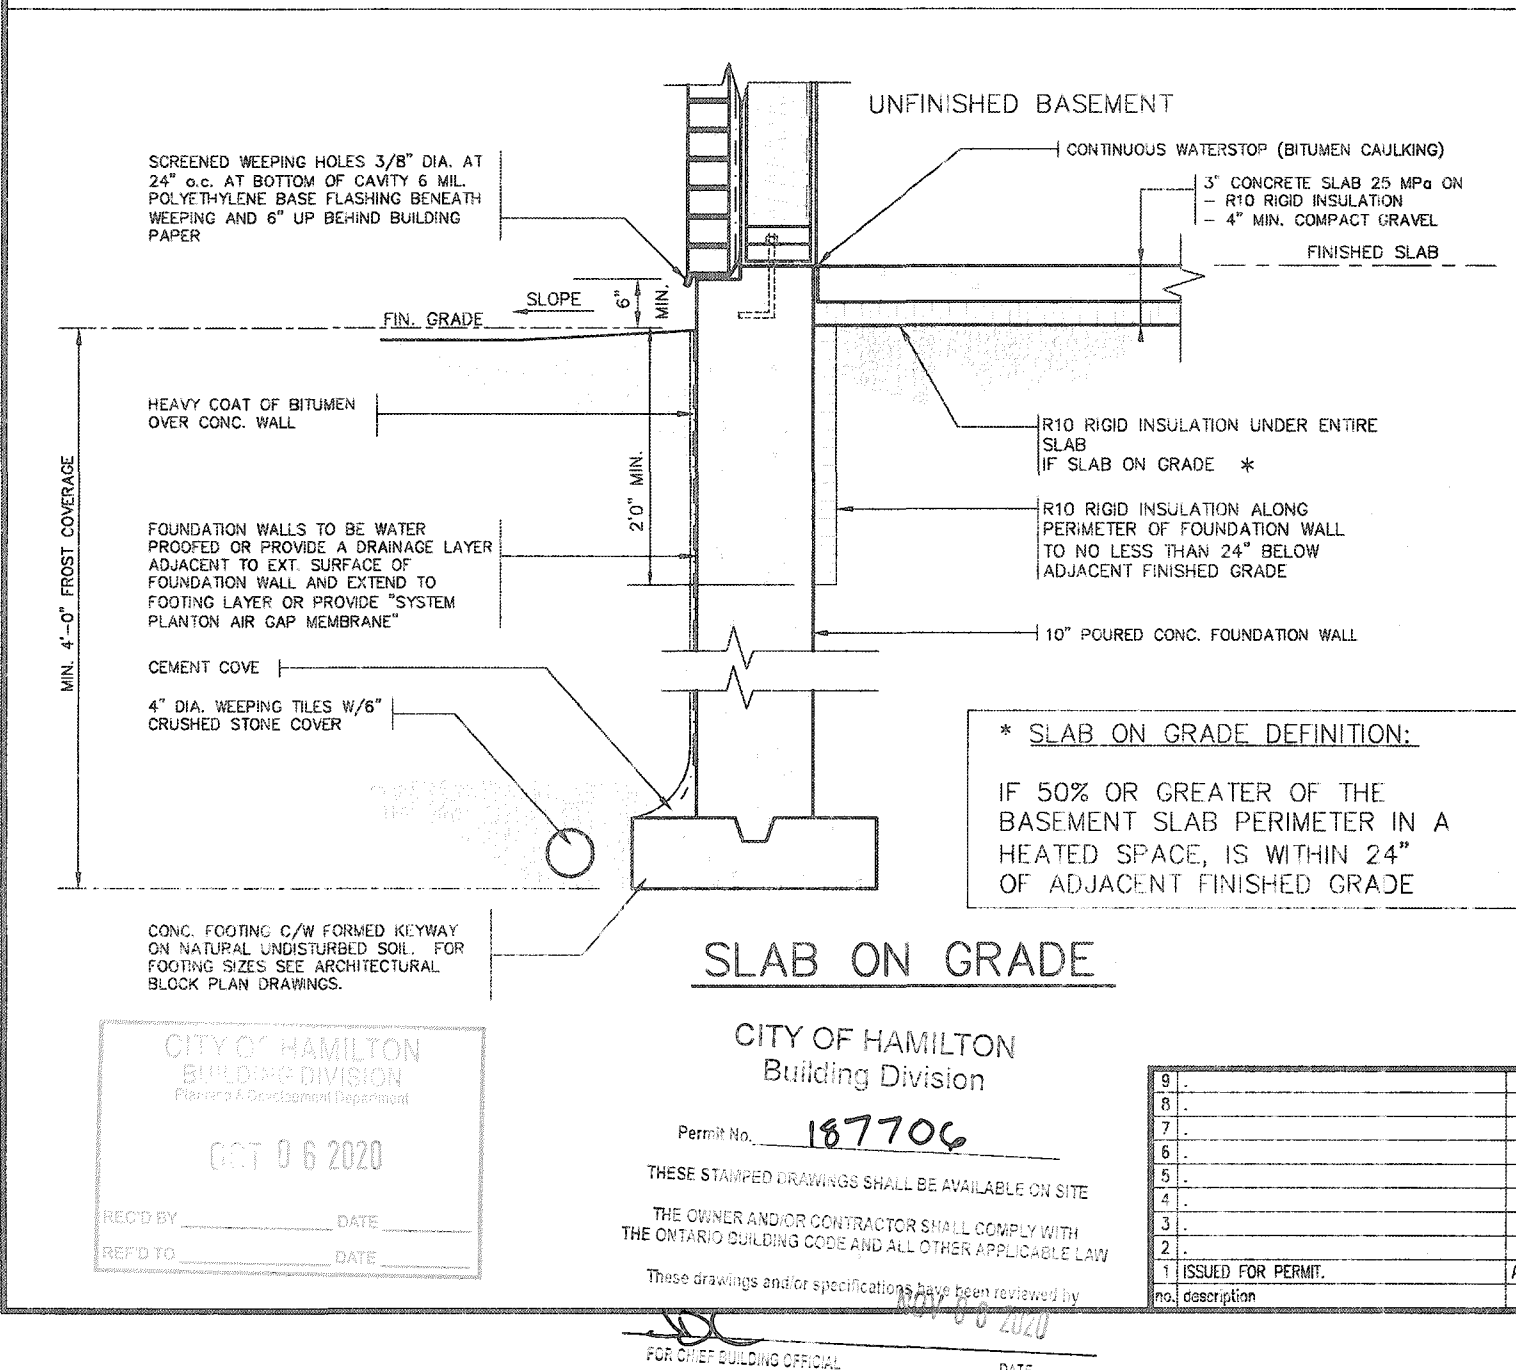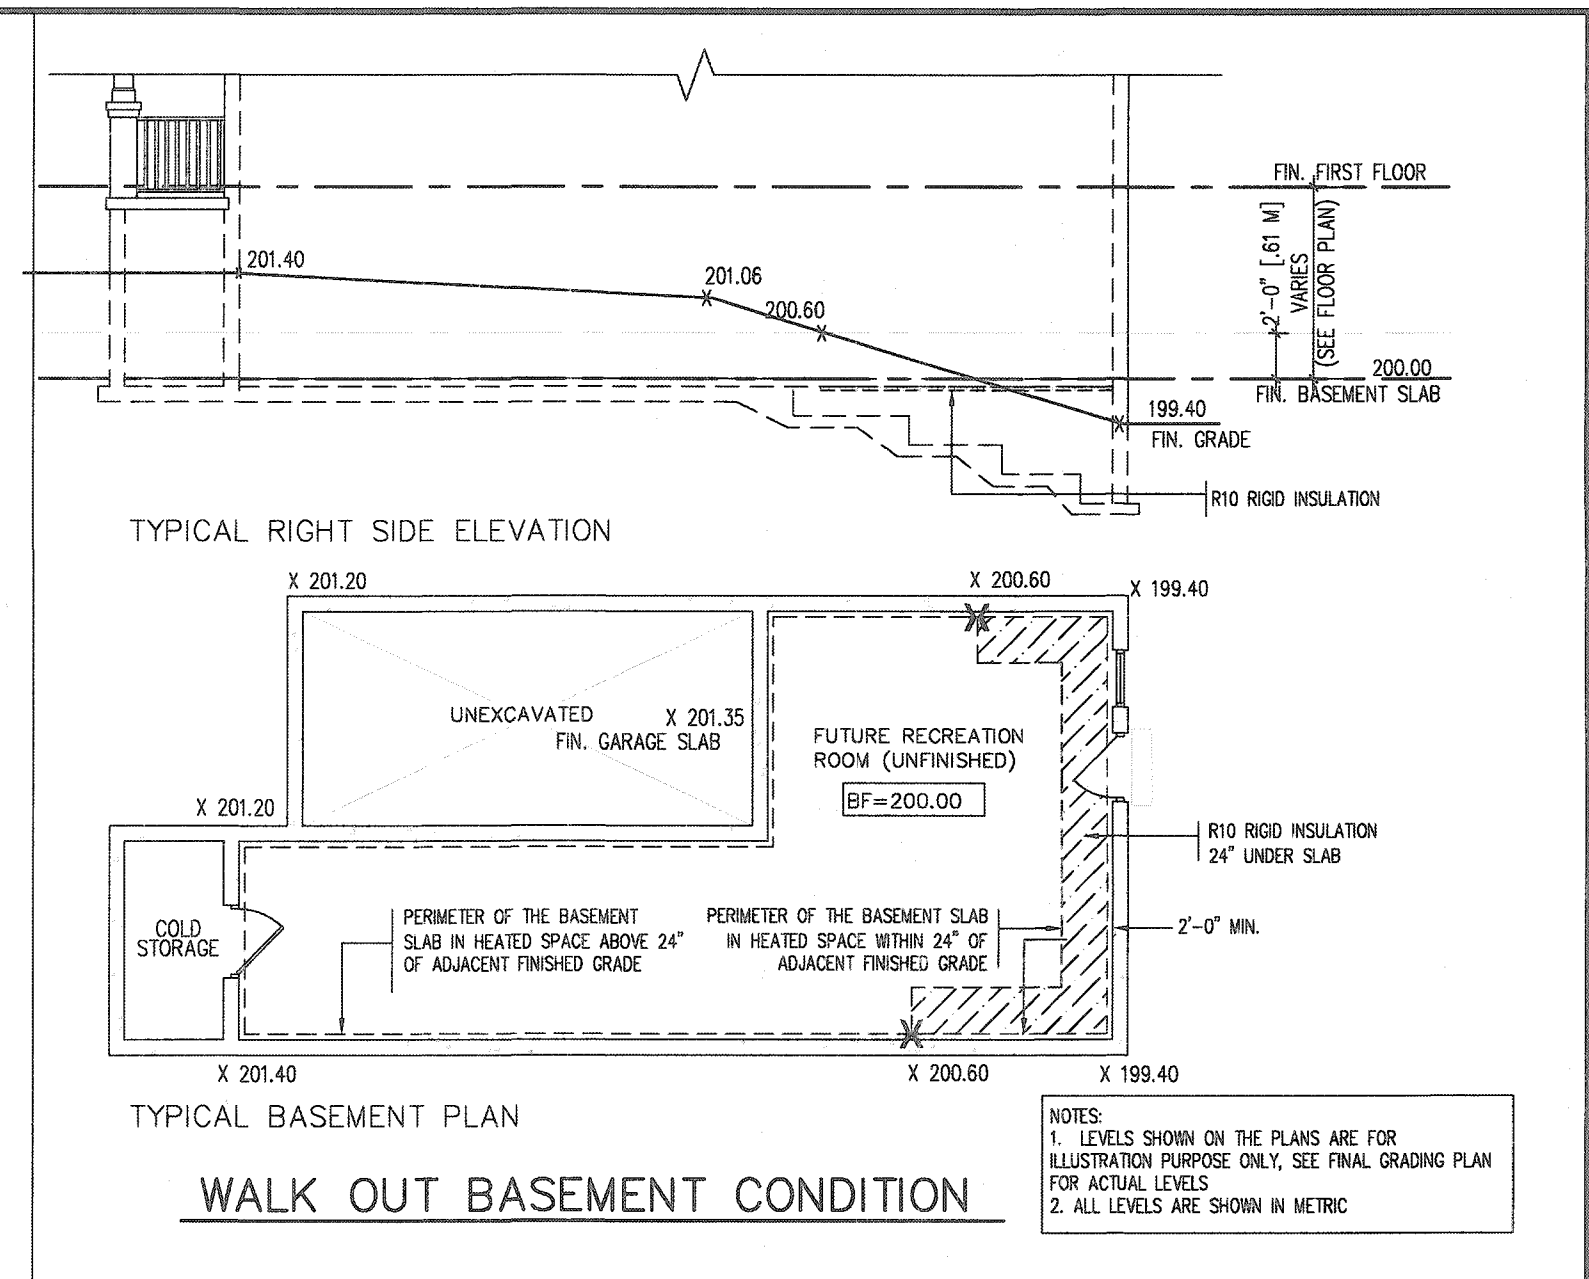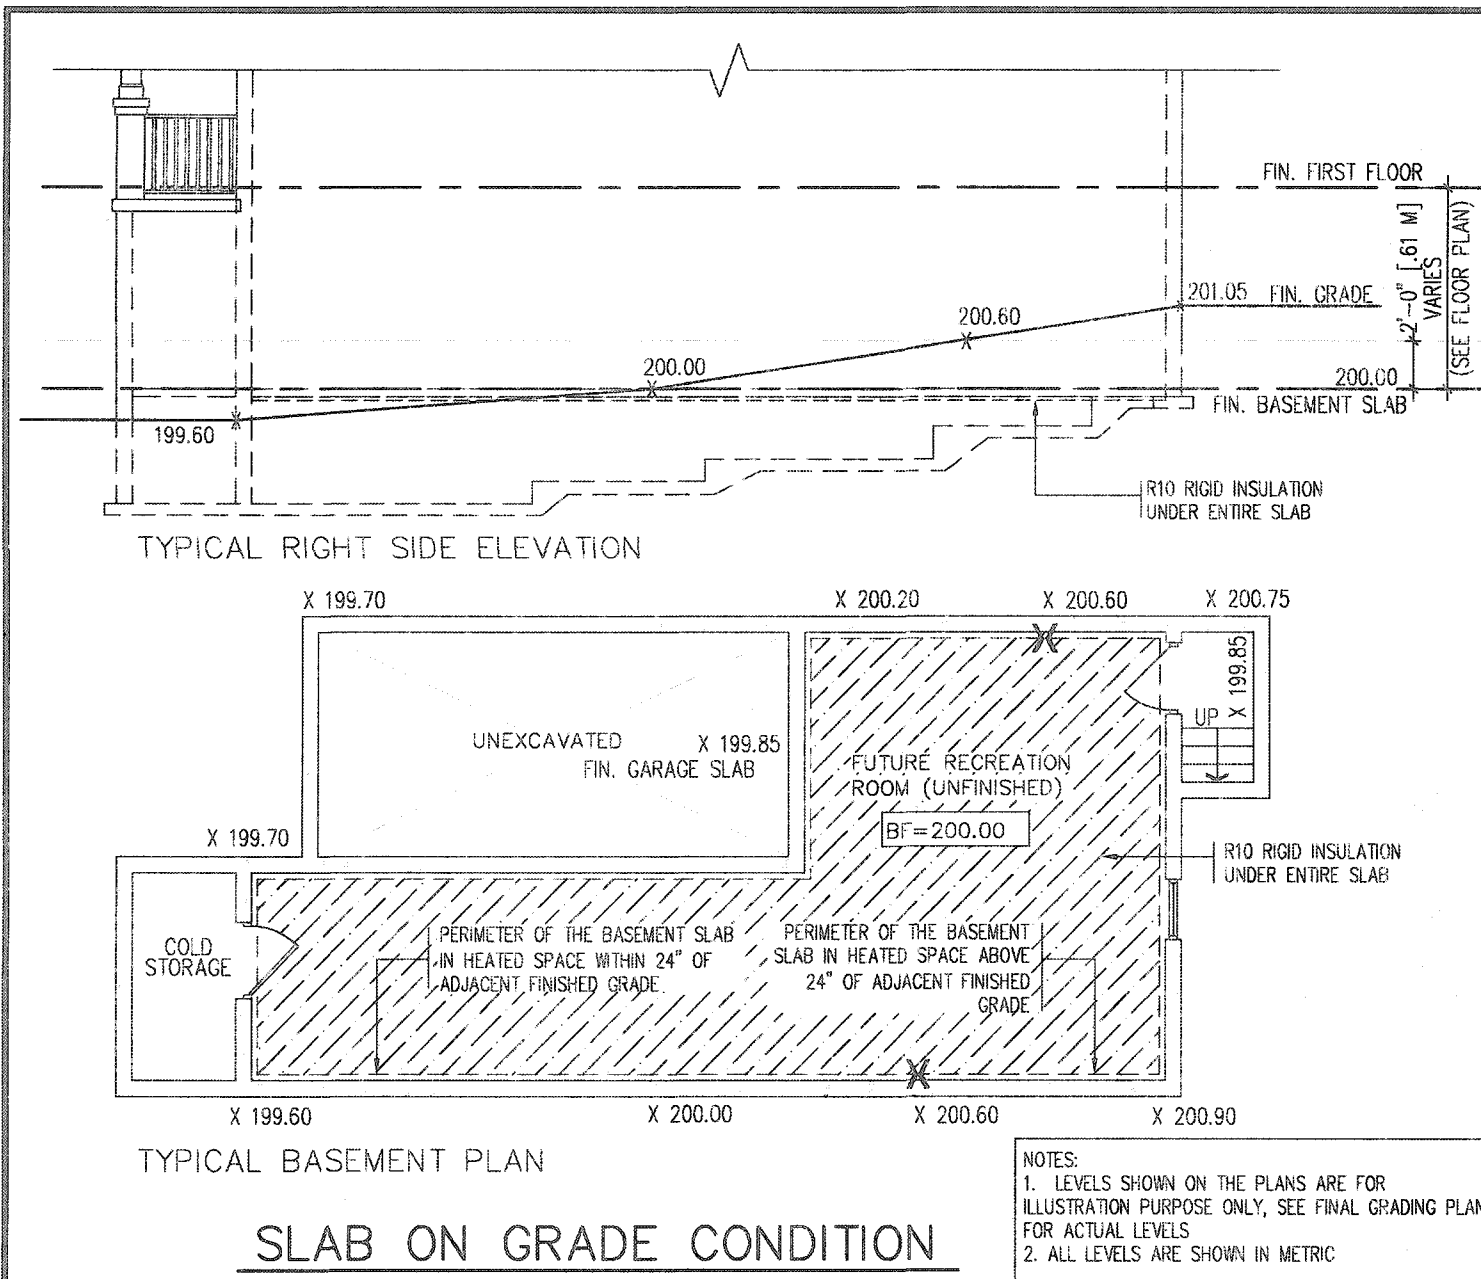

FOUNDATION PLAN


GROUND FLOOR PLAN

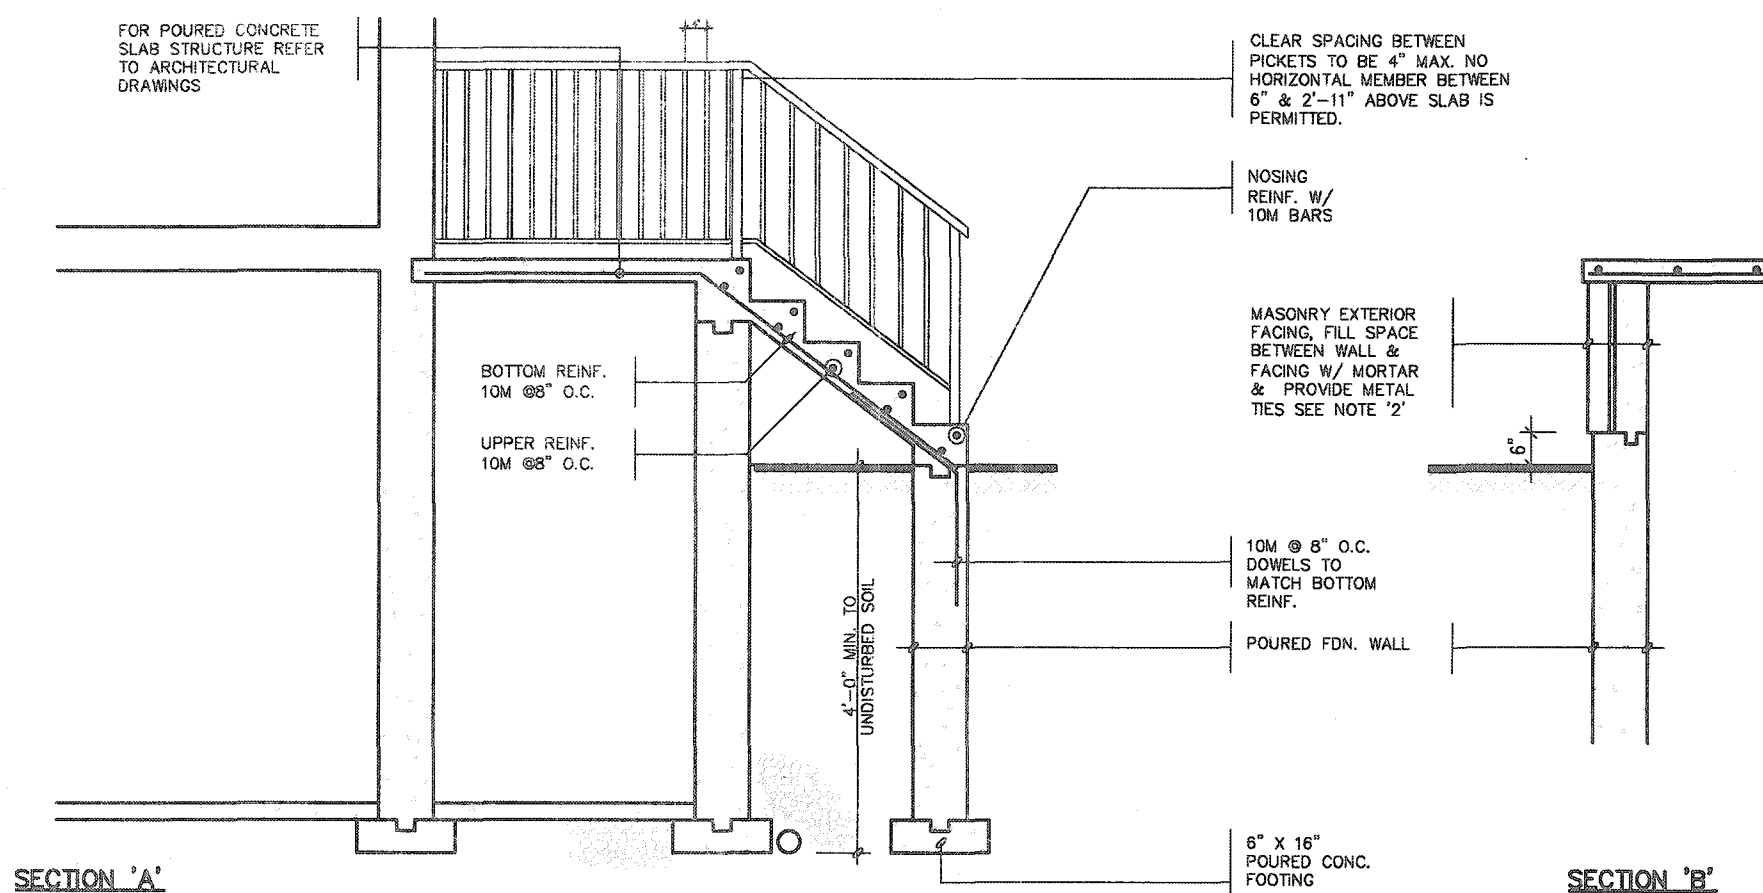


NOTE: FOR MORE THAN 8 RISERS

GENERAL NOTES

1. EXTERIOR STAIRS
7 7/8" RISE MAXIMUM
8 1/4" RUN MINIMUM
9 1/4" TREAD MINIMUM
2. MASONRY TIES
WHEN BRICK FACING IS USED ABOVE GROUND LEVEL, PROVIDE 3/16" DIA. CORROSION RESISTANT METAL TIES @ 36" HORIZONTAL & 8" VERTICAL
3. GUARDS
ARE REQUIRED AROUND CONCRETE SLAB IF MORE THAN 2'-0" ABOVE GRADE & ON BOTH SIDES OF STAIRS CONTAINING MORE THAN 6 RISERS. MINIMUM 34" HIGH FOR STAIRS MINIMUM 36" HIGH FOR PORCHES UP TO 5'-11" ABOVE GRADE. MINIMUM 42" HIGH FOR GREATER HTS.
4. HANDRAIL
ARE REQUIRED WHERE STEPS HAVE MORE THAN 3 RISERS . HANDRAIL HEIGHT 34" - 38".
5. FOUNDATION WALLS
THICKNESS OF FOUNDATION WALLS IS DEPENDANT UPON VENEER CUT 8" FOR UP TO 26" VENEER CUT HEIGHT 10" FOR VENEER CUT OVER 26" HIGH
6. CONCRETE
MINIMUM CONCRETE STRENGTH SHALL BE 4650 PSI [32MPa] w/ 5%-8% AIR ENTRAINMENT MINIMUM CONCRETE SLAB THICKNESS 5"
7. CONCRETE COVER
PROVIDE MINIMUM 3/4" CLEAR CONCRETE COVER TO REINFORCING BARS

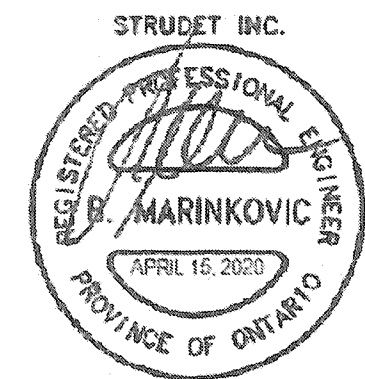

FOR STRUCTURE ONLY

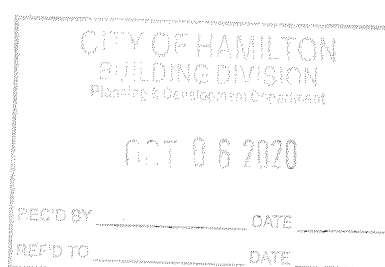

CITY OF HAMILTON
Building Division

Permit No. 187706

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by _____

FOR CHIEF BUILDING OFFICIAL NOV 8 6 2020
DATE


				The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer
9				qualified on information
8				Richard Vink 2446
7				name signature BC
6				registration information VA3 Design Inc. 4260
5				
4				
3				
2				
1	ISSUED FOR PERMIT.	A/R 13/20 GW		Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be copied or reproduced without written permission.
	no description	date	hw	




SINGLES

project name	project no.
RUSSELL GARDENS PH. 3	19014
city	county
WATERDOWN	
date	drawing no.
APRIL 2020	
drawn by	scale
GW	Not to Scale
check by	file name
-	19014-GP-STD_DETAILS_A1


All drawings, specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.

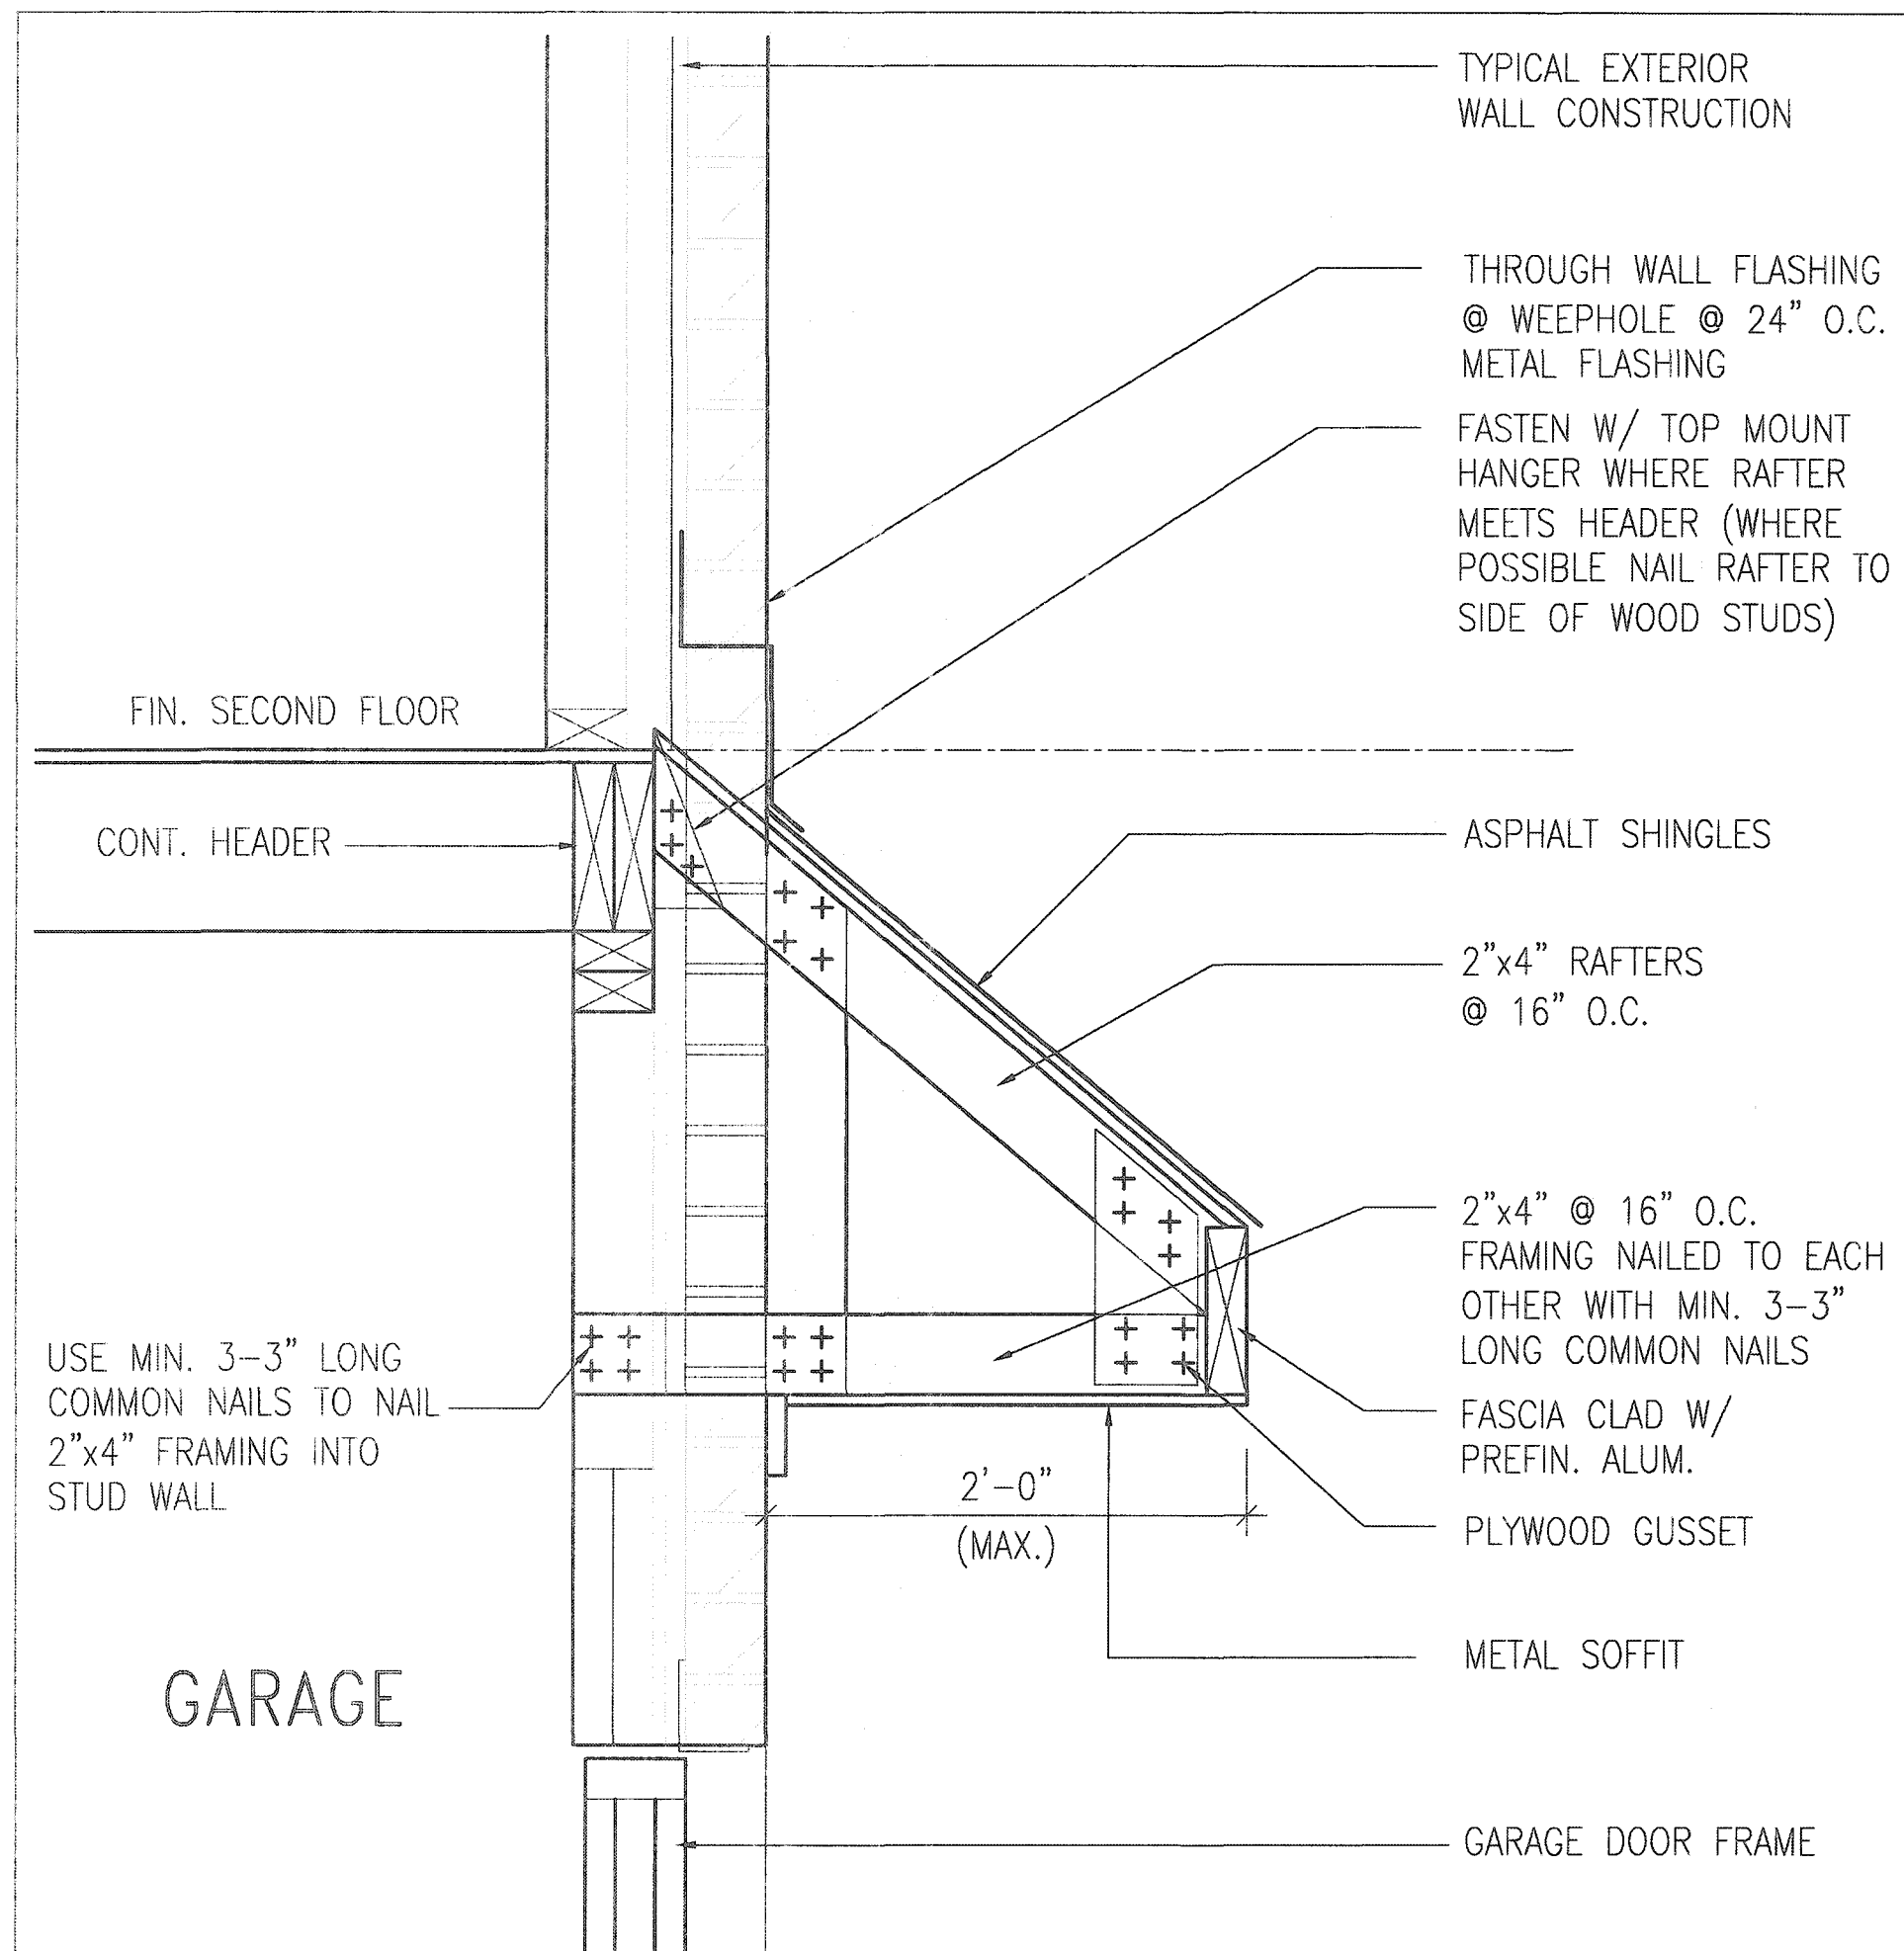

B ROOF OVERHANG DETAIL OVER GARAGE

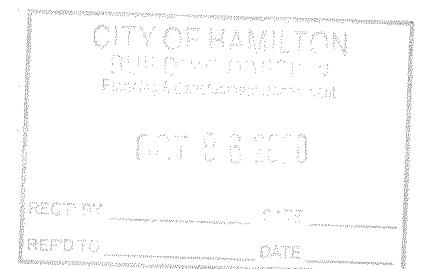

CITY OF HAMILTON
Building Division
Permit No. **187706**
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed
JDC NOV 06 2020
FOR CHIEF BUILDING OFFICIAL DATE

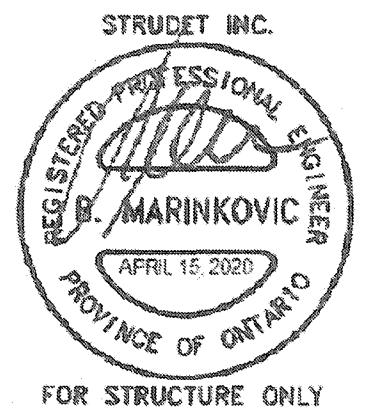

2012 CODE
COMPLIANCE PACKAGE A1

9 8 7 6 5 4 3 2 1 ISSUED FOR PERMIT APR 13/20 GW	The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. qualification information Richard Vink 24488 name signature BCN registration information VAS Design Inc. 42858 Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.	VAS DESIGN 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 vasdesign.com	Greenpark. project name RUSSELL GARDENS PH. 3 date APRIL 2020 drawn by GW checked by - scale Not to Scale	SINGLES project no. 19014 detail of extended roof 19014-GP-STD_DETAILS_A1 drawing no. 12
--	---	--	---	--

SUPPORTED STEEL
ANGLE UP TO
11'-7". OTHERWISE
TO BE REVIEWED BY
ENGINEER.

BRICK/
STONE
VENEER

INVERTED
3-1/2"x3-1/2"x1/4"
(90x90x6.0)
STEEL ANGLE


MIN. 12"

INVERTED
3-1/2"x3-1/2"x1/4"
(90x90x6.0)
STEEL ANGLE


BRICK/
STONE
VENEER

SUPPORTED STEEL
ANGLE UP TO 11'-7".
OTHERWISE TO BE
REVIEWED BY ENGINEER.

INVERTED STEEL ANGLE DETAIL

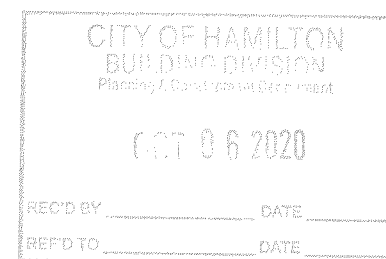

CITY OF HAMILTON
Building Division
Permit No. **187706**
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
[Signature] NOV 06 2020
FOR CHIEF BUILDING OFFICIAL DATE

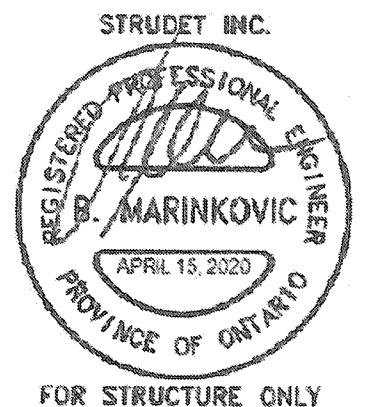

2012 CODE COMPLIANCE PACKAGE A1

9. The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. 8. qualification information 7. Richard Vink 24488 6. name signature BDN 5. registration information 42658 4. VAS Design Inc. 3. Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled. 2. 1 ISSUED FOR PERMIT. APR 13/20 GW 1. no. description date by	13	VA3 DESIGN 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 va3design.com	Greenpark project name RUSSELL GARDENS PH. 3 date APRIL 2020 drawn by GW checked by - scales No! to Scale	SINGLES project no. 19014 drawing no. 13 19014-CP-STD-DETAILS_A1
---	-----------	--	---	---

