

FROM PLAN DATED:

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS PH 3

MODEL: MOUNTAINASH 3

ELEVATION: 1

LOT:

CITY: WATERDOWN

SALESMAN: MARIO DICIANO

DESIGNER: AJ

REVISION:

NOTES:

REFER TO THE **NORDIC INSTALLATION** GUIDE FOR PROPER STORAGE AND INSTALLATION.

SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING CANT' OVER BRICK REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7, TABLES 1 & 2. **CERAMIC TILE** APPLICATION AS PER O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000


LIVE LOAD: 40.0 lb/ft²

DEAD LOAD: 20.0 lb/ft²

SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 2020-02-10

1st FLOOR

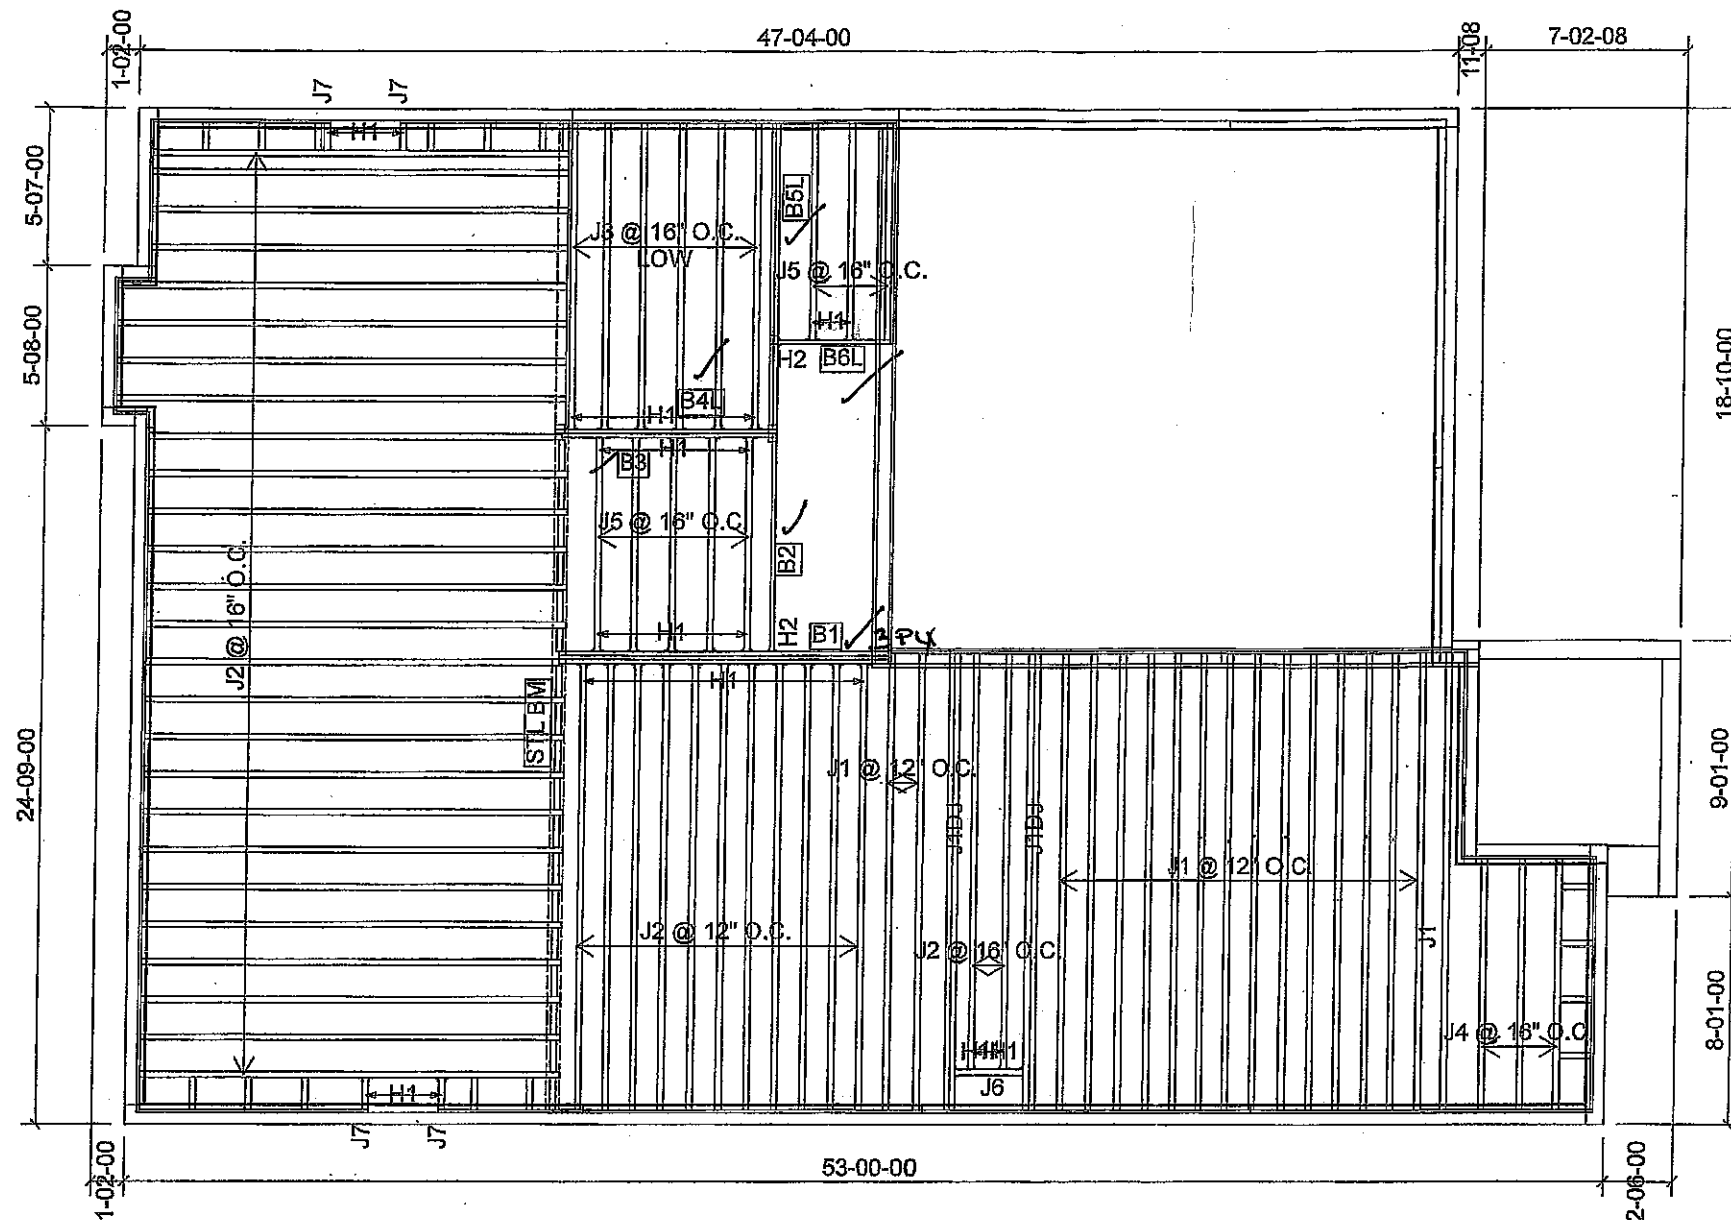

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
J1	18-00-00	9 1/2" NI-40x	1	17	MFD
J1DJ	18-00-00	9 1/2" NI-40x	2	4	MFD
J2	16-00-00	9 1/2" NI-40x	1	39	MFD
J3	12-00-00	9 1/2" NI-40x	1	6	MFD
J4	10-00-00	9 1/2" NI-40x	1	3	MFD
J5	8-00-00	9 1/2" NI-40x	1	8	MFD
J6	4-00-00	9 1/2" NI-40x	1	1	MFD
J7	2-00-00	9 1/2" NI-40x	1	4	MFD
B5L	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B1	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3	MFD
B2	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B3	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B4L	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B6L	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD

Connector Summary		
Qty	Manuf	Product
13	H1	IUS2.56/9.5
2	H1	IUS2.56/9.5
16	H1	IUS2.56/9.5
6	H1	IUS2.56/9.5
1	H2	HUS1.81/10
1	H2	HUS1.81/10

CITY OF HAMILTON
Building Division

Permit No. 196110

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE


THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

DEC 15 2020

FOR CHIEF BUILDING OFFICIAL DATE

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department
OCT 06 2020
REC BY DATE
REF'D TO DATE

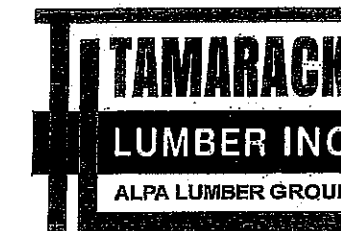

FROM PLAN DATED:

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS PH 3

MODEL: MOUNTAINASH 3

ELEVATION: 1

LOT:

CITY: WATERDOWN

SALESMAN: MARIO DICIANO

DESIGNER: AJ

REVISION:

NOTES:

REFER TO THE **NORDIC INSTALLATION** GUIDE FOR PROPER STORAGE AND INSTALLATION.

SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING CANT' OVER BRICK RE I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR HOLES INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7, TABLES 1 & 2. **CERAMIC TILE** APPLICATION AS PER O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²


DEAD LOAD: 20.0 lb/ft²

SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 2020-04-15

1st FLOOR

DECK CONDITION

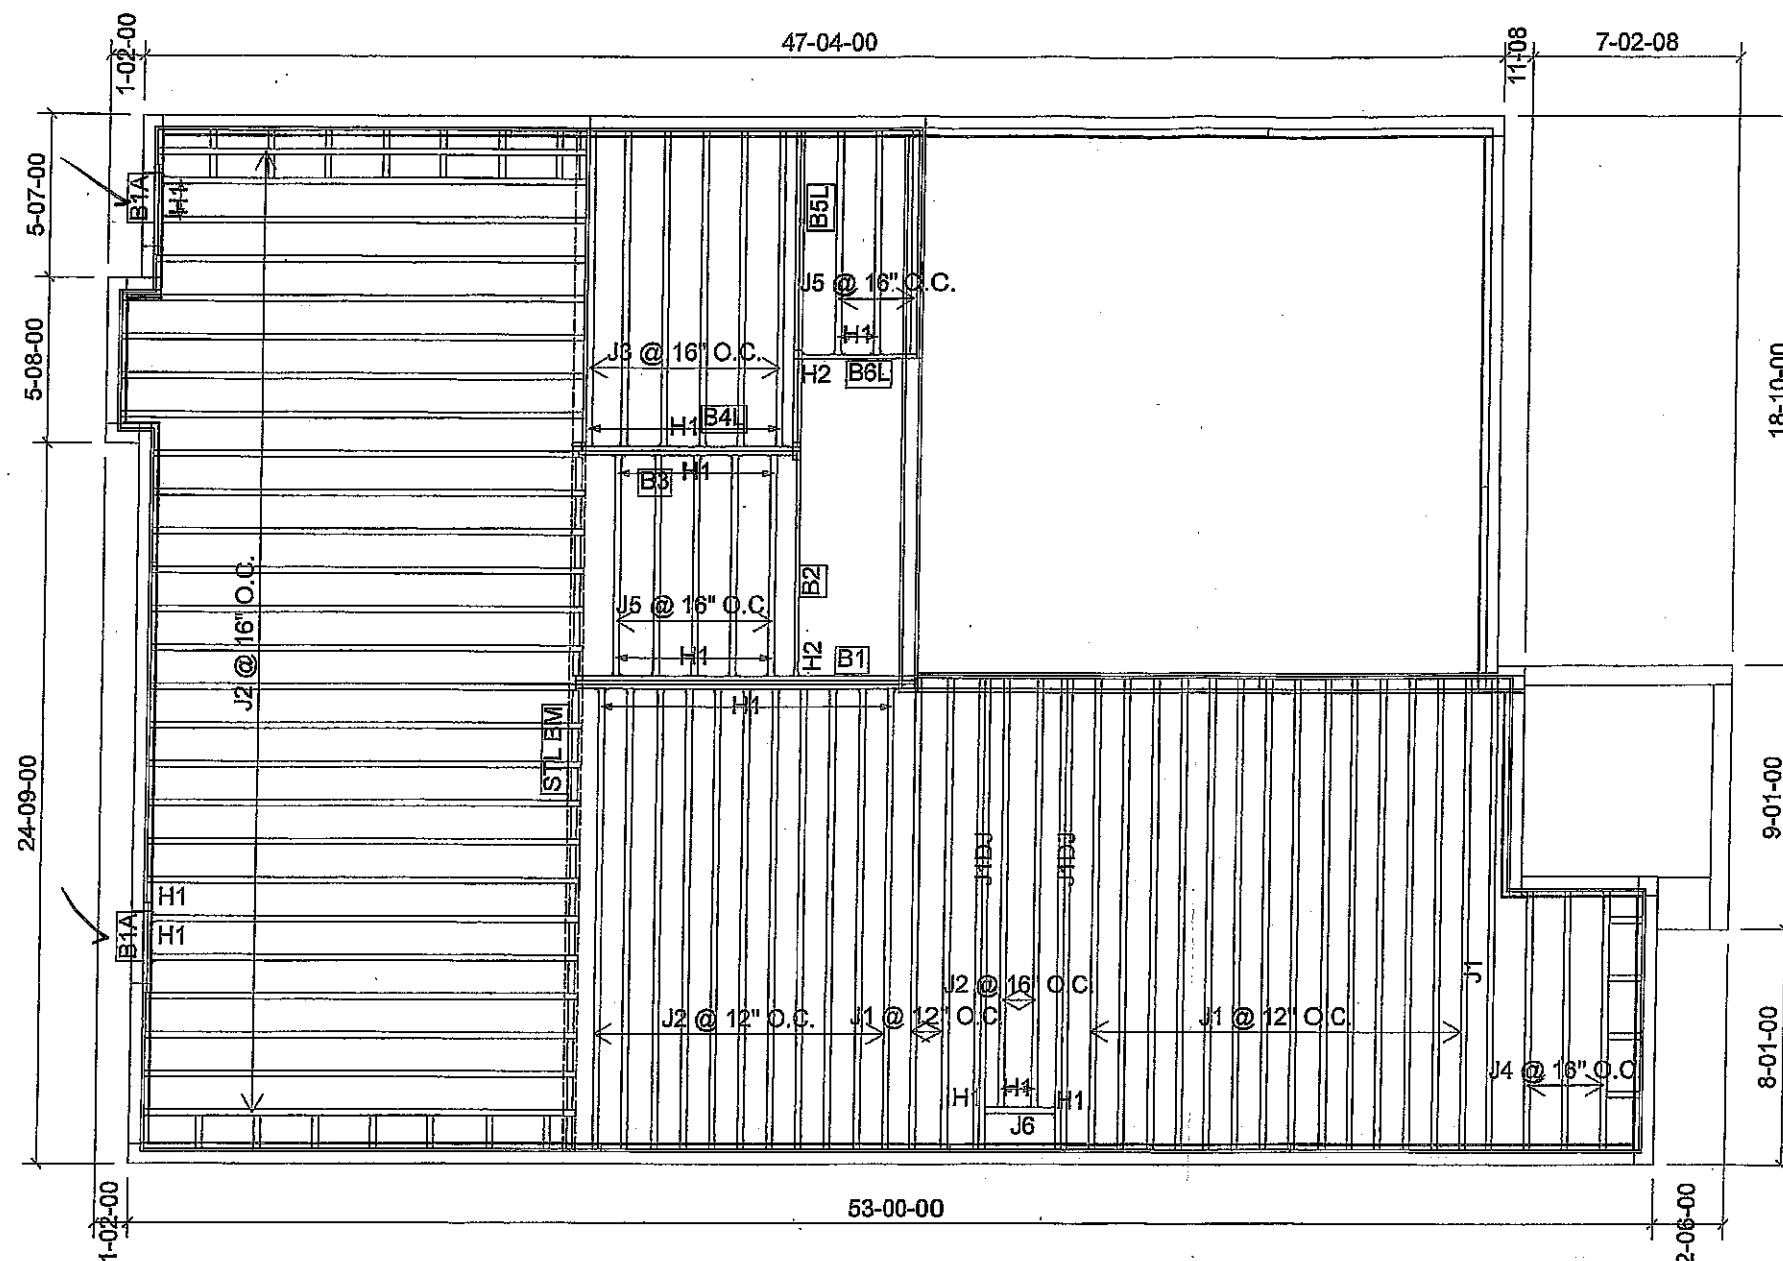

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
J1	18-00-00	9 1/2" NI-40x	1	17	MFD
J1DJ	18-00-00	9 1/2" NI-40x	2	4	MFD
J2	16-00-00	9 1/2" NI-40x	1	39	MFD
J3	12-00-00	9 1/2" NI-40x	1	6	MFD
J4	10-00-00	9 1/2" NI-40x	1	3	MFD
J5	8-00-00	9 1/2" NI-40x	1	8	MFD
J6	4-00-00	9 1/2" NI-40x	1	1	MFD
B5L	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B1	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3	MFD
B2	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B3	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B4L	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B6L	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B1A	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	4	MFD

Connector Summary		
Qty	Manuf	Product
13	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
2	H1	IUS2.56/9.5
16	H1	IUS2.56/9.5
2	H1	IUS2.56/9.5
1	H2	HUS1.81/10
1	H2	HUS1.81/10

CITY OF HAMILTON
Building Division

196110

Permit No.

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE


THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW


These drawings and/or specifications have been reviewed by

FOR CHIEF BUILDING OFFICIAL

DEC 15 2020

DATE

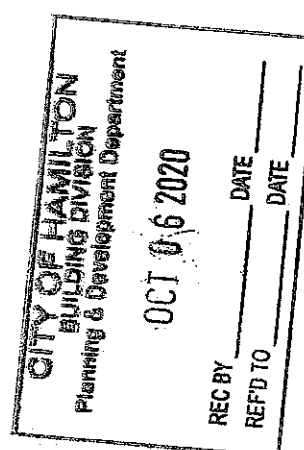

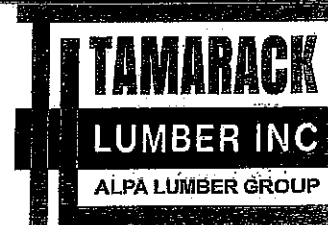

FROM PLAN DATED:

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS PH 3

MODEL: MOUNTAINASH 3

ELEVATION: 2

LOT:

CITY: WATERDOWN

SALESMAN: MARIO DICIANO

DESIGNER: AJ

REVISION:

NOTES:

REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION.

SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. MULTIPLE SQUASH BLOCKS REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. CANTILEVERED JOISTS INCLUDING CANT' OVER BRICK REQ. JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR HOLES INCLUDING DUCT CHASE AND FIELD CUT OPENINGS SEE FIGURE 7, TABLES 1 & 2. CERAMIC TILE APPLICATION AS PER O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000


LIVE LOAD: 40.0 lb/ft²

DEAD LOAD: 20.0 lb/ft²

SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 2020-02-10

1st FLOOR

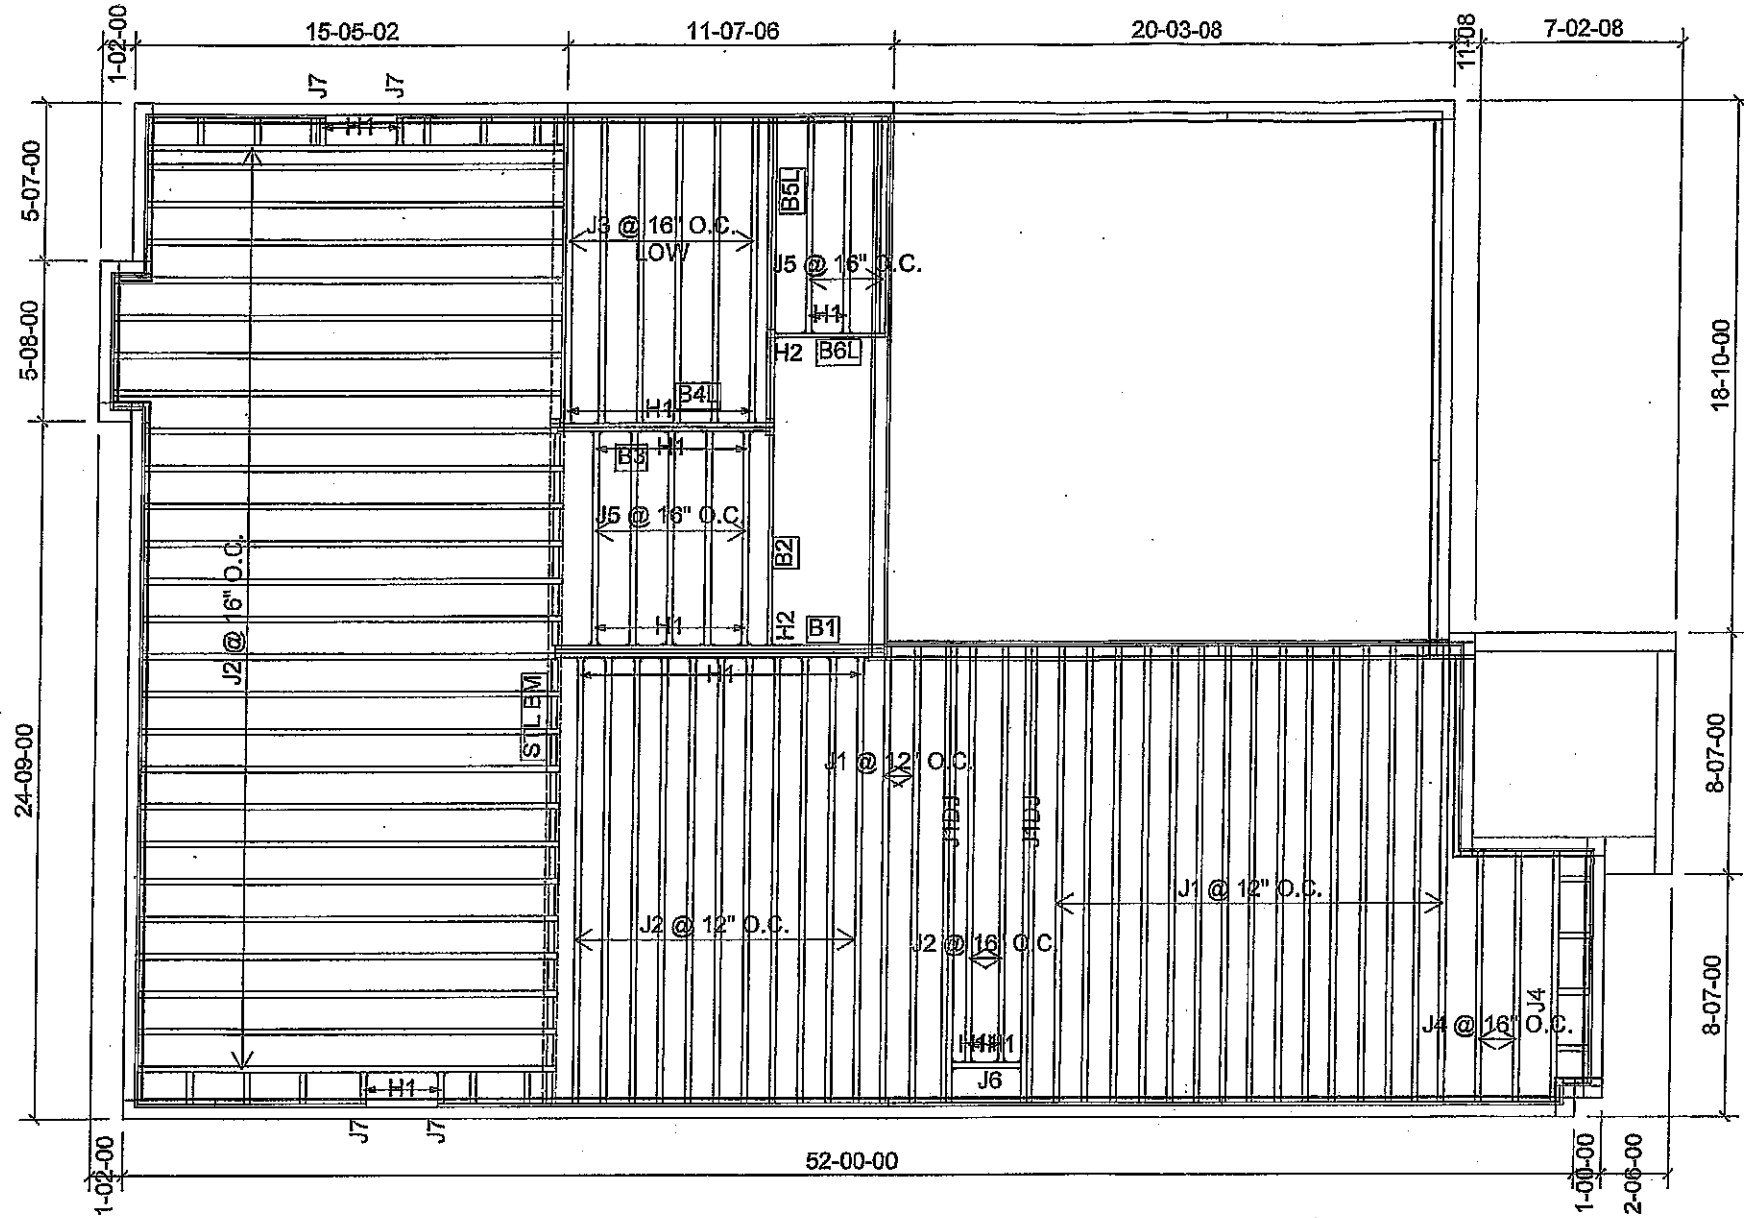

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
J1	18-00-00	9 1/2" NI-40x	1	17	MFD
J1DJ	18-00-00	9 1/2" NI-40x	2	4	MFD
J2	16-00-00	9 1/2" NI-40x	1	39	MFD
J3	12-00-00	9 1/2" NI-40x	1	6	MFD
J4	10-00-00	9 1/2" NI-40x	1	3	MFD
J5	8-00-00	9 1/2" NI-40x	1	8	MFD
J6	4-00-00	9 1/2" NI-40x	1	1	MFD
J7	2-00-00	9 1/2" NI-40x	1	4	MFD
B5L	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B1	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3	MFD
B2	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B3	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B4L	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B6L	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD

Connector Summary		
Qty	Manuf	Product
13	H1	IUS2.56/9.5
2	H1	IUS2.56/9.5
16	H1	IUS2.56/9.5
6	H1	IUS2.56/9.5
1	H2	HUS1.81/10
1	H2	HUS1.81/10

CITY OF HAMILTON
Building Division

Permit No. 196110

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

DEC 15 2020

FOR CHIEF BUILDING OFFICIAL


DATE

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department
OCT 06 2020
REC BY DATE
REFD TO DATE

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department

OCT 06 2020

REC BY _____ DATE _____
REFD TO _____ DATE _____

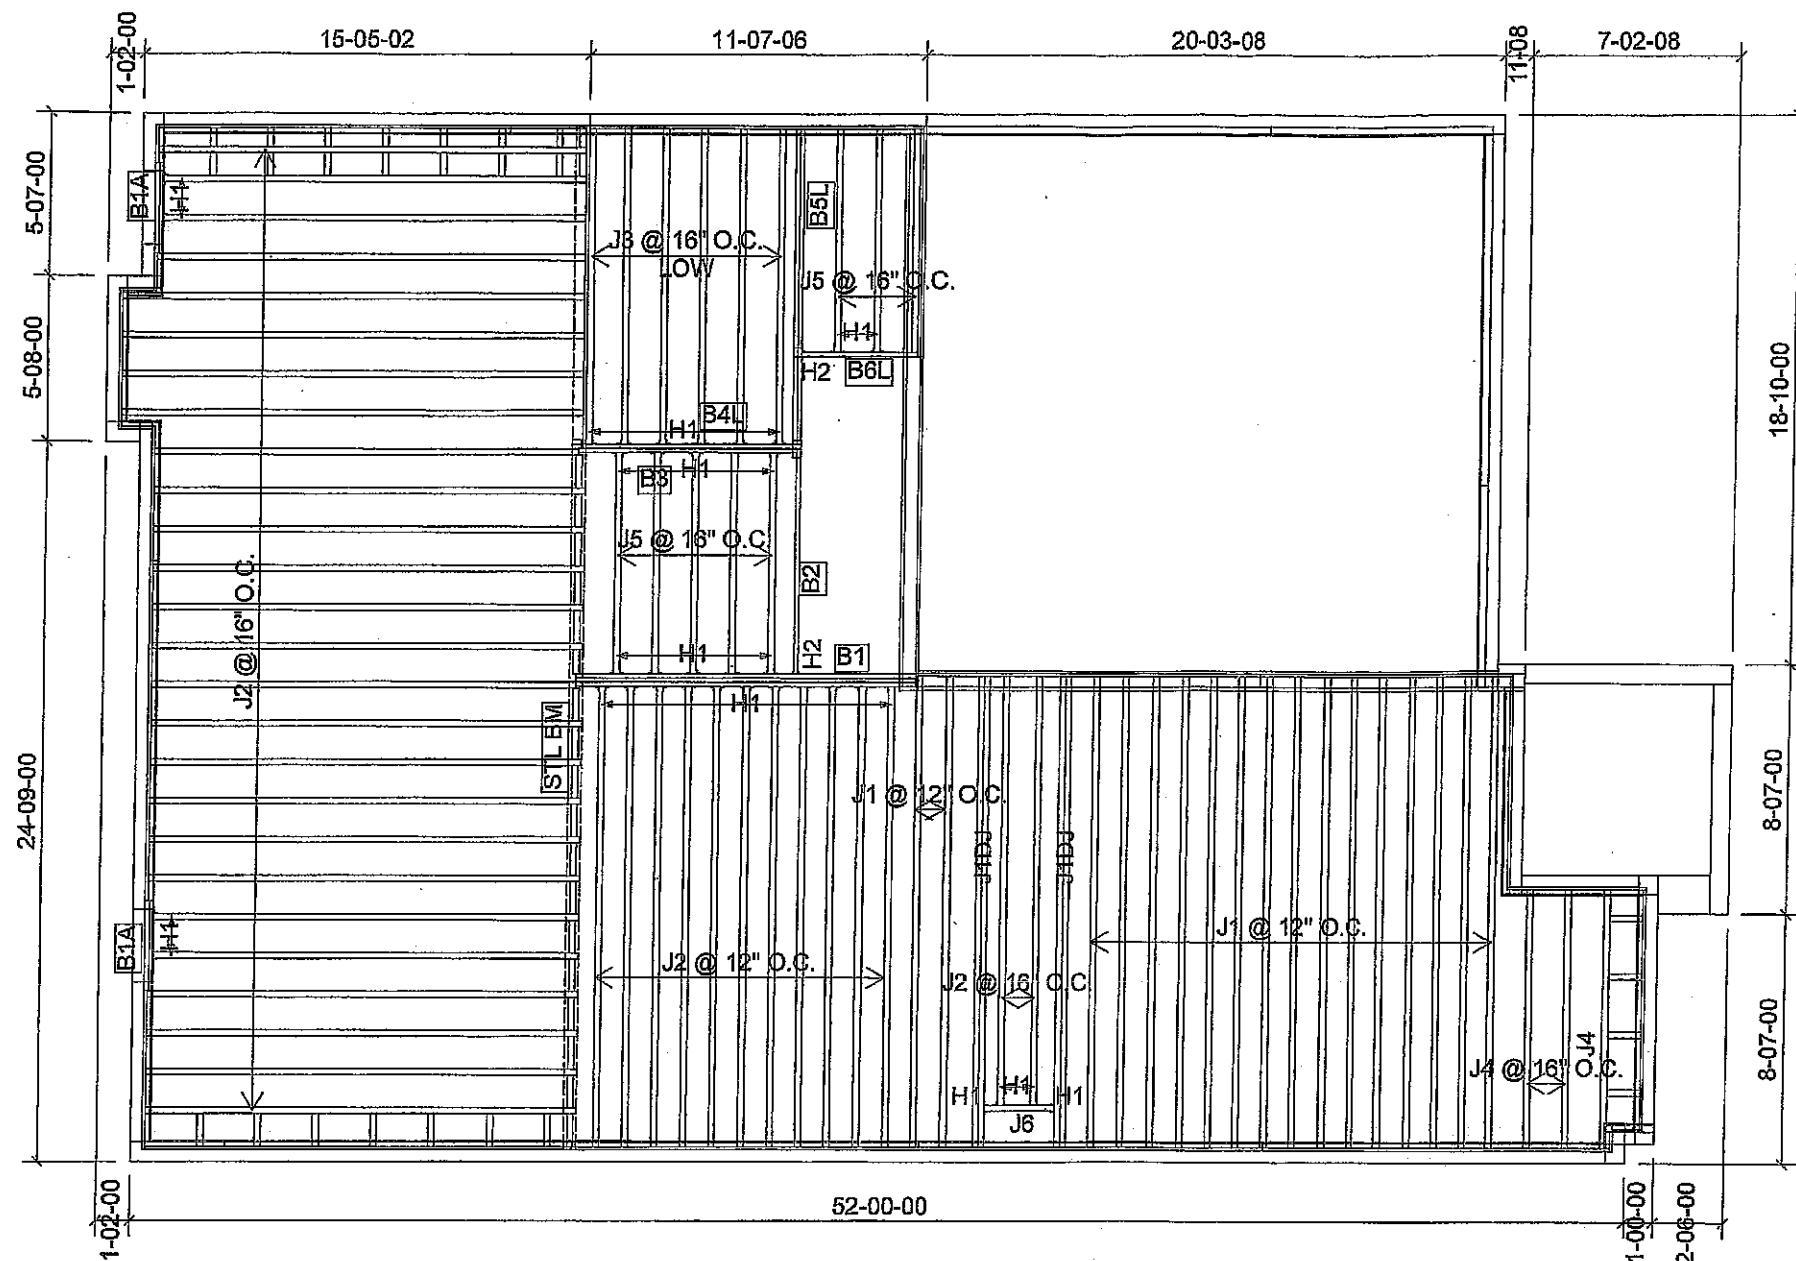

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
J1	18-00-00	9 1/2" NI-40x	1	17	MFD
J1DJ	18-00-00	9 1/2" NI-40x	2	4	MFD
J2	16-00-00	9 1/2" NI-40x	1	39	MFD
J3	12-00-00	9 1/2" NI-40x	1	6	MFD
J4	10-00-00	9 1/2" NI-40x	1	3	MFD
J5	8-00-00	9 1/2" NI-40x	1	8	MFD
J6	4-00-00	9 1/2" NI-40x	1	1	MFD
B5L	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B1	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3	MFD
B2	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B3	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B4L	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B6L	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B1A	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	4	MFD

Connector Summary		
Qty	Manuf	Product
13	H1	IUS2.56/9.5
2	H1	IUS2.56/9.5
2	H1	IUS2.56/9.5
16	H1	IUS2.56/9.5
2	H1	IUS2.56/9.5
2		IUS2.56/9.5
1	H2	HUS1.81/10
1	H2	HUS1.81/10

CITY OF HAMILTON
Building Division

Project No. 196110


THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE CANADIAN BUILDING CODE AND ALL OTHER APPLICABLE LAW

Drawings and/or specifications have been reviewed by

DEC 15 2020

DATE

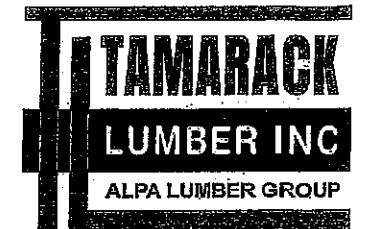

FROM PLAN DATED:

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS PH 3

MODEL: MOUNTAINASH 3

ELEVATION: 2

LOT:

CITY: WATERDOWN

SALESMAN: MARIO DICIANO

DESIGNER: AJ

REVISION:

NOTES:

REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION.

SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. MULTIPLE SQUASH BLOCKS REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. CANTILEVERED JOISTS INCLUDING CANT' OVER BRICK RE I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR HOLES INCLUDING DUCT CHASE AND FIELD CUT OPENINGS SEE FIGURE 7, TABLES 1 & 2. CERAMIC TILE APPLICATION AS PER O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²


DEAD LOAD: 20.0 lb/ft²

SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 2020-04-15

1st FLOOR

DECK CONDITION

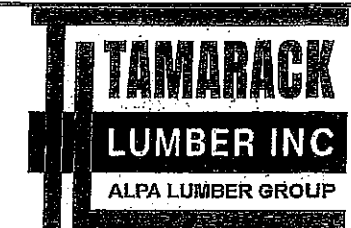

FROM PLAN DATED:

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS PH 3

MODEL: MOUNTAINASH 3

ELEVATION: 3

LOT:

CITY: WATERDOWN

SALESMAN: MARIO DICIANO

DESIGNER: AJ

REVISION:

NOTES:

REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION.

SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. MULTIPLE SQUASH BLOCKS REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. CANTILEVERED JOISTS INCLUDING CANT' OVER BRICK REQ. JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR HOLES INCLUDING DUCT CHASE AND FIELD CUT OPENINGS SEE FIGURE 7, TABLES 1 & 2. CERAMIC TILE APPLICATION AS PER O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000


LIVE LOAD: 40.0 lb/ft²

DEAD LOAD: 20.0 lb/ft²

SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 2020-02-10

1st FLOOR

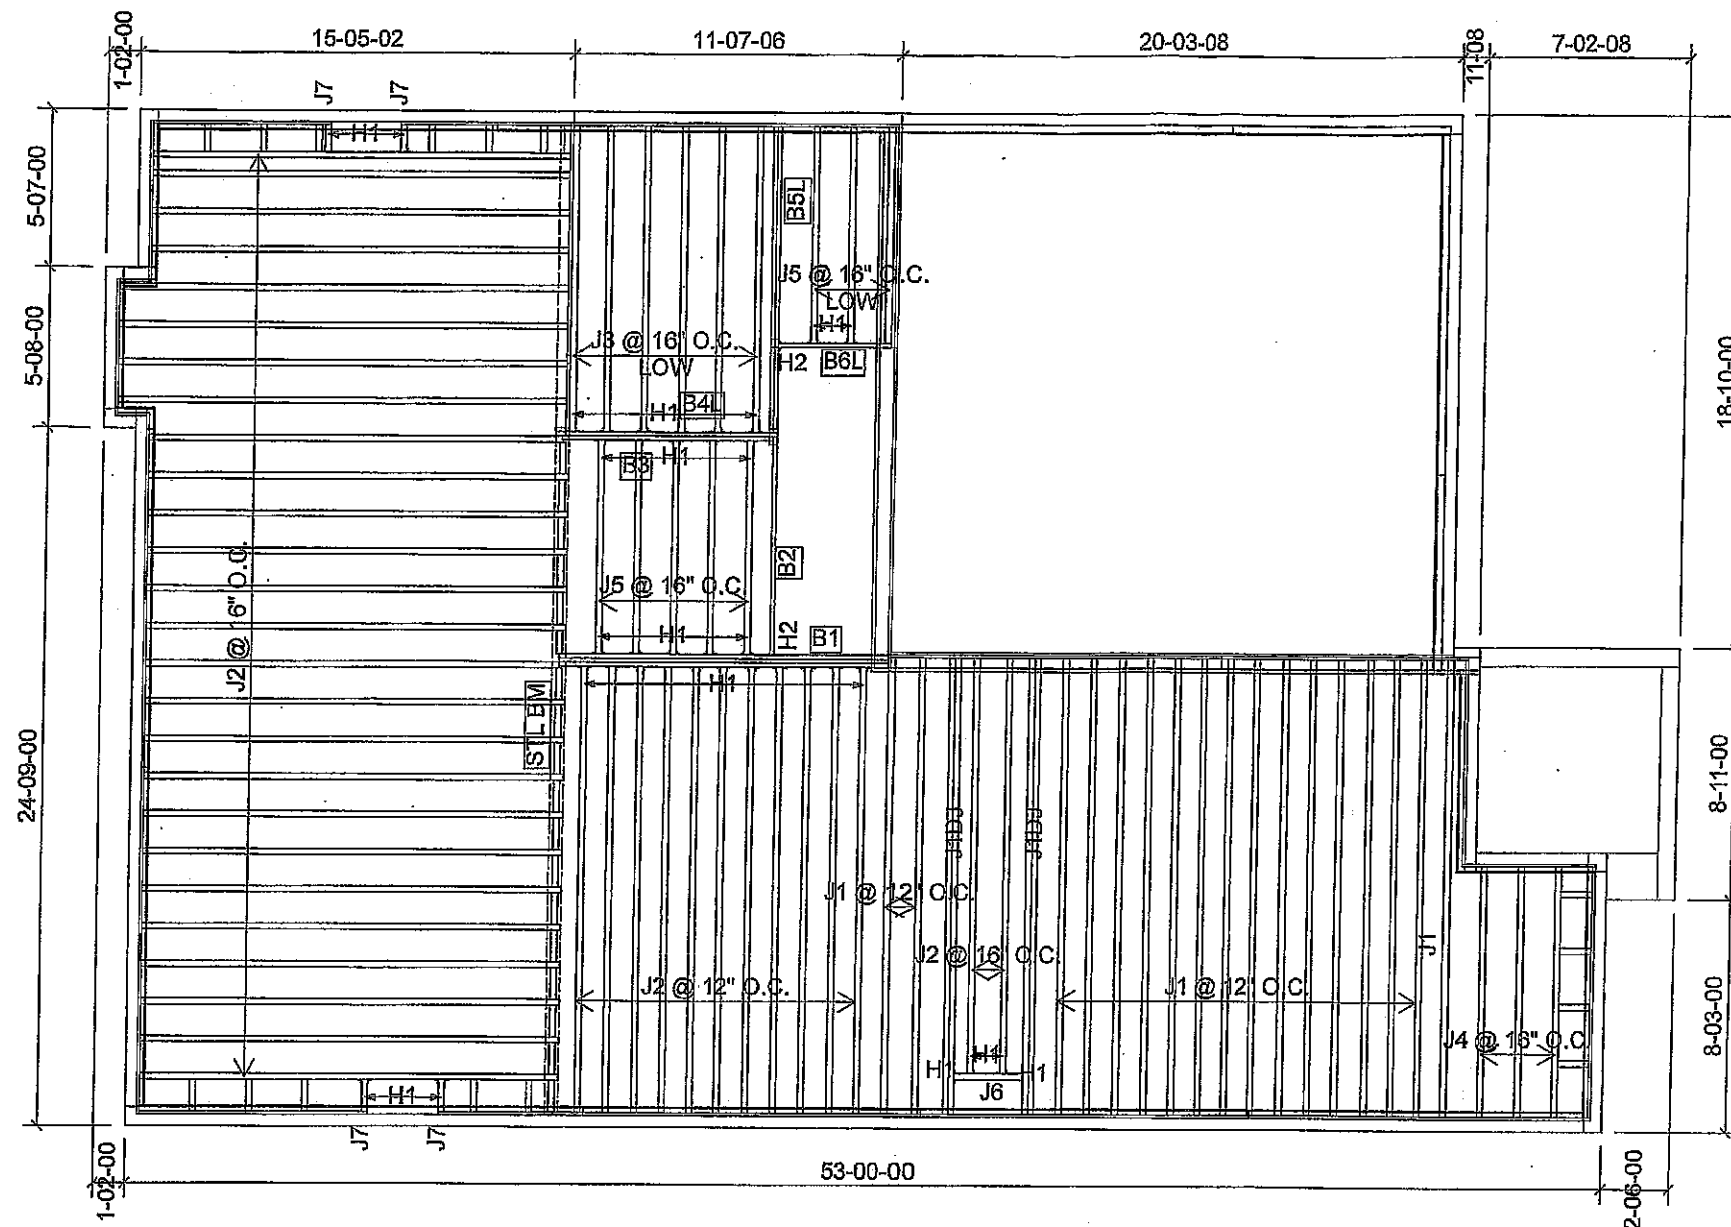

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
J1	18-00-00	9 1/2" NI-40x	1	17	MFD
J1DJ	18-00-00	9 1/2" NI-40x	2	4	MFD
J2	16-00-00	9 1/2" NI-40x	1	39	MFD
J3	12-00-00	9 1/2" NI-40x	1	6	MFD
J4	10-00-00	9 1/2" NI-40x	1	3	MFD
J5	8-00-00	9 1/2" NI-40x	1	8	MFD
J6	4-00-00	9 1/2" NI-40x	1	1	MFD
J7	2-00-00	9 1/2" NI-40x	1	4	MFD
B5L	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B1	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3	MFD
B2	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B3	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B4L	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B6L	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD

Connector Summary		
Qty	Manuf	Product
13	H1	IUS2.56/9.5
2	H1	IUS2.56/9.5
16	H1	IUS2.56/9.5
6	H1	IUS2.56/9.5
1	H2	HUS1.81/10
1	H2	HUS1.81/10

CITY OF HAMILTON
Building Division

Permit No. 196110

THE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

FOR CHIEF BUILDING OFFICIAL


DEC 15 2020

DATE

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department

OCT 16 2020

REC BY DATE
REF TO DATE

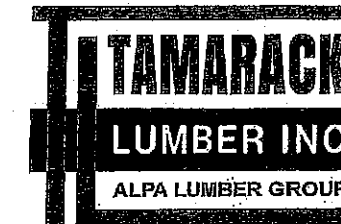

FROM PLAN DATED:

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS PH 3

MODEL: MOUNTAINASH 3

ELEVATION: 3

LOT:

CITY: WATERDOWN

SALESMAN: MARIO DICIANO

DESIGNER: AJ

REVISION:

NOTES:

REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION.

SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. MULTIPLE SQUASH BLOCKS REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. CANTILEVERED JOISTS INCLUDING CANT' OVER BRICK REI I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR HOLES INCLUDING DUCT CHASE AND FIELD CUT OPENINGS SEE FIGURE 7, TABLES 1 & 2. CERAMIC TIL APPLICATION AS PER O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²


DEAD LOAD: 20.0 lb/ft²

SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 2020-04-15

1st FLOOR

DECK CONDITION

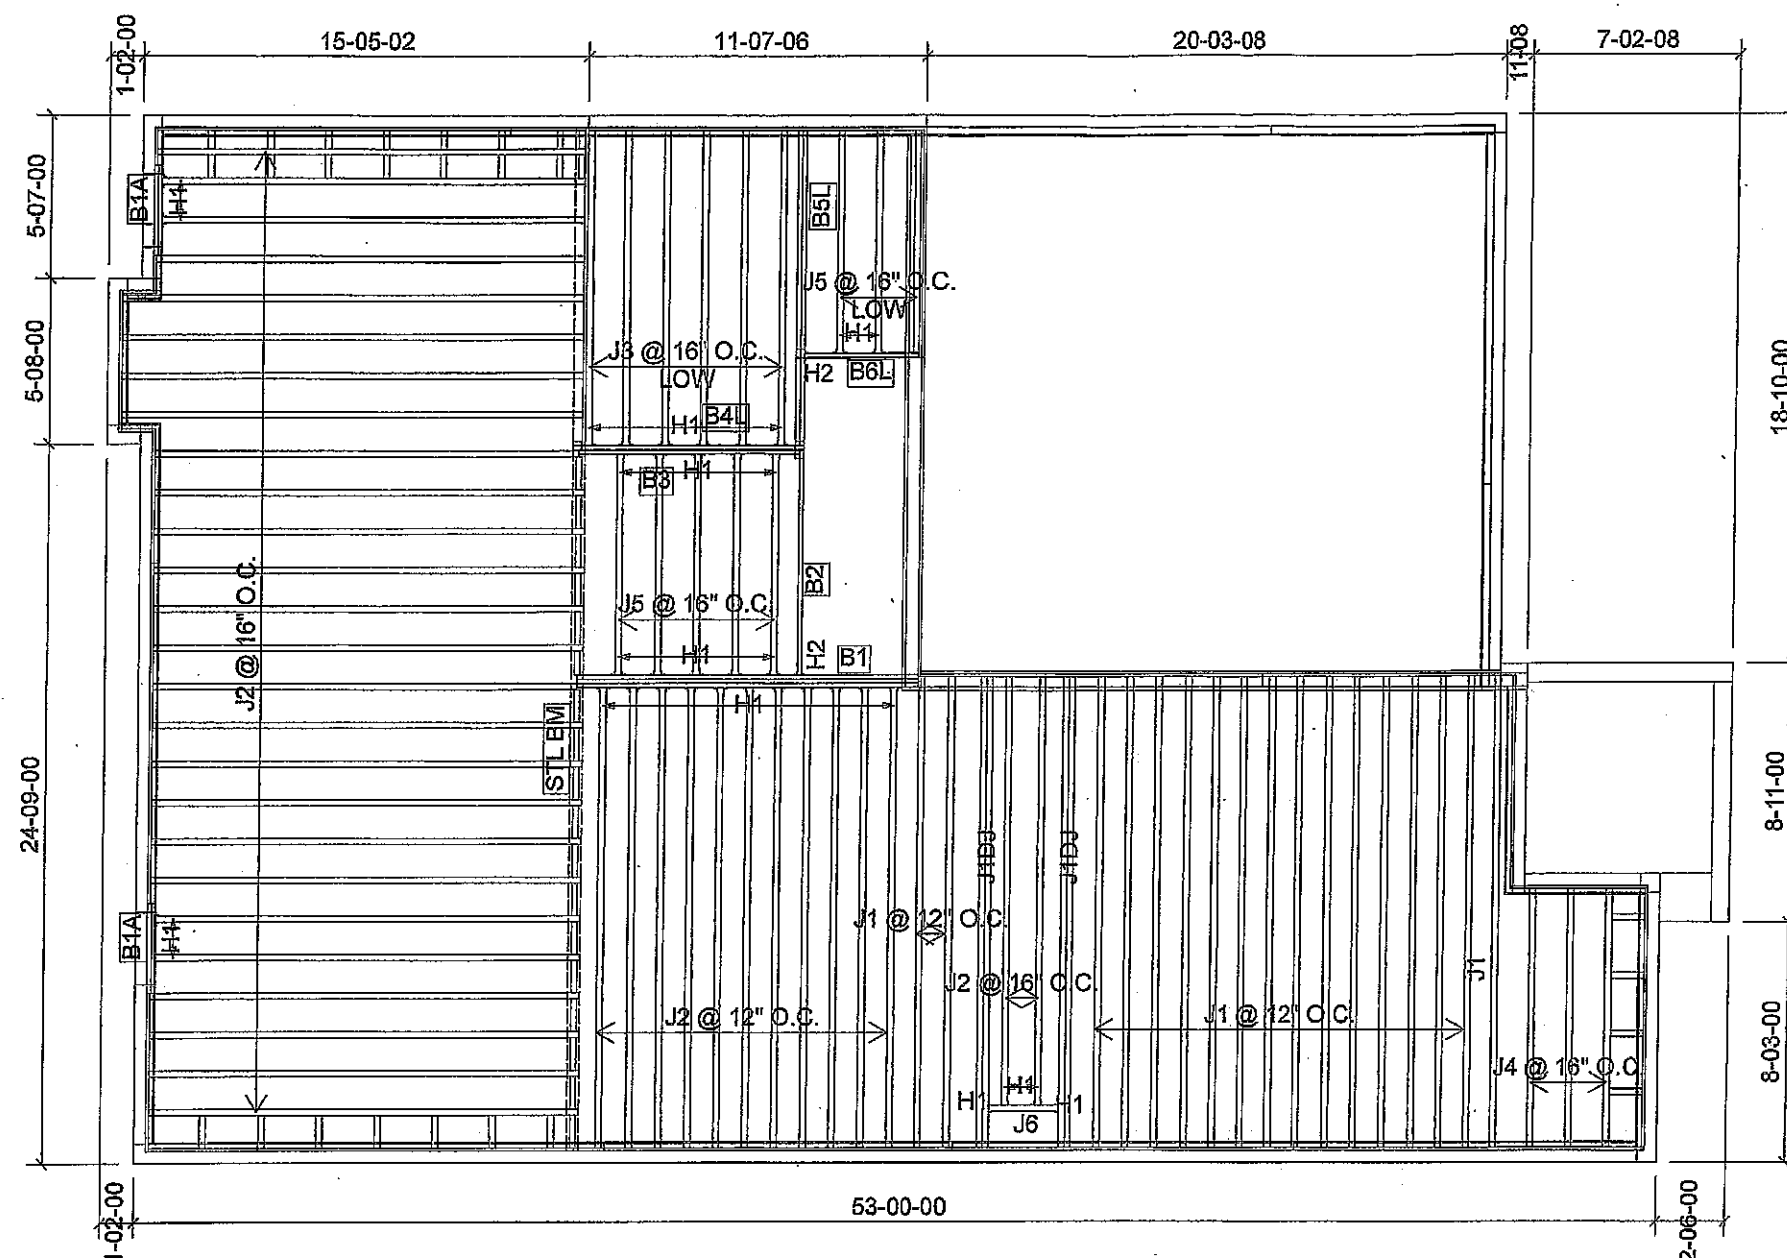

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
J1	18-00-00	9 1/2" NI-40x	1	17	MFD
J1DJ	18-00-00	9 1/2" NI-40x	2	4	MFD
J2	16-00-00	9 1/2" NI-40x	1	39	MFD
J3	12-00-00	9 1/2" NI-40x	1	6	MFD
J4	10-00-00	9 1/2" NI-40x	1	3	MFD
J5	8-00-00	9 1/2" NI-40x	1	8	MFD
J6	4-00-00	9 1/2" NI-40x	1	1	MFD
B5L	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B1	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3	MFD
B2	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B3	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B4L	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B6L	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B1A	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	4	MFD


Connector Summary		
Qty	Manuf	Product
13	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
2	H1	IUS2.56/9.5
16	H1	IUS2.56/9.5
2	H1	IUS2.56/9.5
1	H2	HUS1.81/10
1	H2	HUS1.81/10

CITY OF HAMILTON
Building Division
196110

These drawings and/or specifications have been reviewed by
DEC 15 2020
DATE

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department
OCT 06 2020
REC BY
REFD TO
DATE
DATE

OCT 16 2020

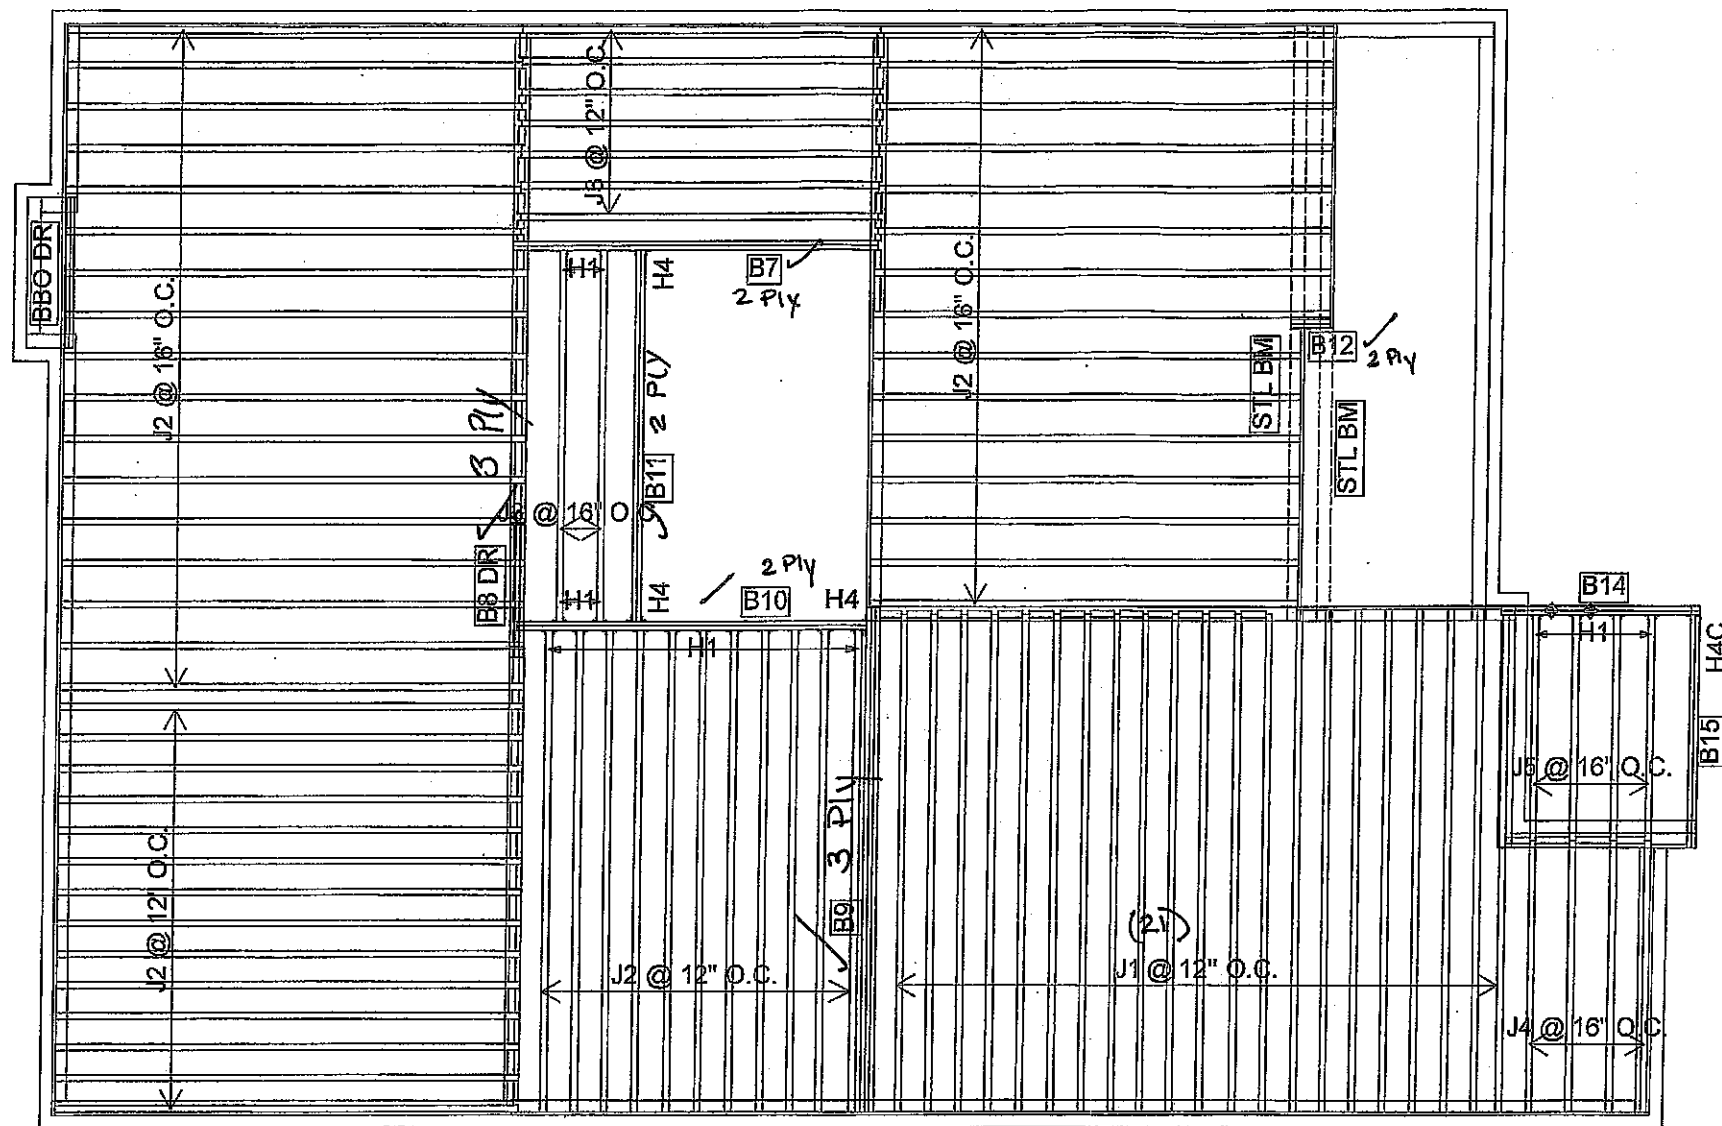REC BY _____ DATE _____
REFD TO _____ DATE _____

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
✓J1	18-00-00	9 1/2" NI-40x	1	21	MFD
J2	16-00-00	9 1/2" NI-40x	1	57	MFD
J3	12-00-00	9 1/2" NI-40x	1	9	MFD
J4	10-00-00	9 1/2" NI-40x	1	4	MFD
J5	8-00-00	9 1/2" NI-40x	1	4	MFD
✓B9	18-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3	MFD
✓B10	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
✓B11	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
✓B7	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B14	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B15	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
✓B8 DR	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3	MFD
✓B12	2-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD

Connector Summary

Qty	Manuf	Product
19	H1	IUS2.56/9.5
1	H4C	HUC410
2	H4	HGUS410
1	H4	HGUS410

CITY OF HAMILTON
Building Division


Permit No. 196110

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAWThese drawings and/or specifications have been reviewed by
DEC 15 2020

FOR CHIEF, BUILDING OFFICIAL

DATE

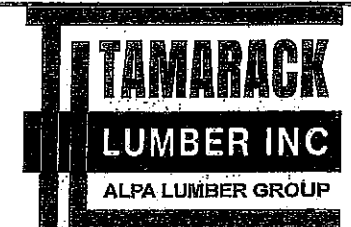

FROM PLAN DATED:

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS PH 3

MODEL: MOUNTAINASH 3

ELEVATION: 1

LOT:

CITY: WATERDOWN

SALESMAN: MARIO DICIANO

DESIGNER: AJ

REVISION:

NOTES:

REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²DEAD LOAD: 20.0 lb/ft²


SUBFLOOR: 5/8" GLUED AND NAILED

DATE: 2020-02-14

2nd FLOOR

STD

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department
OCT 6 2020
REC BY _____ DATE _____
REFD TO _____ DATE _____

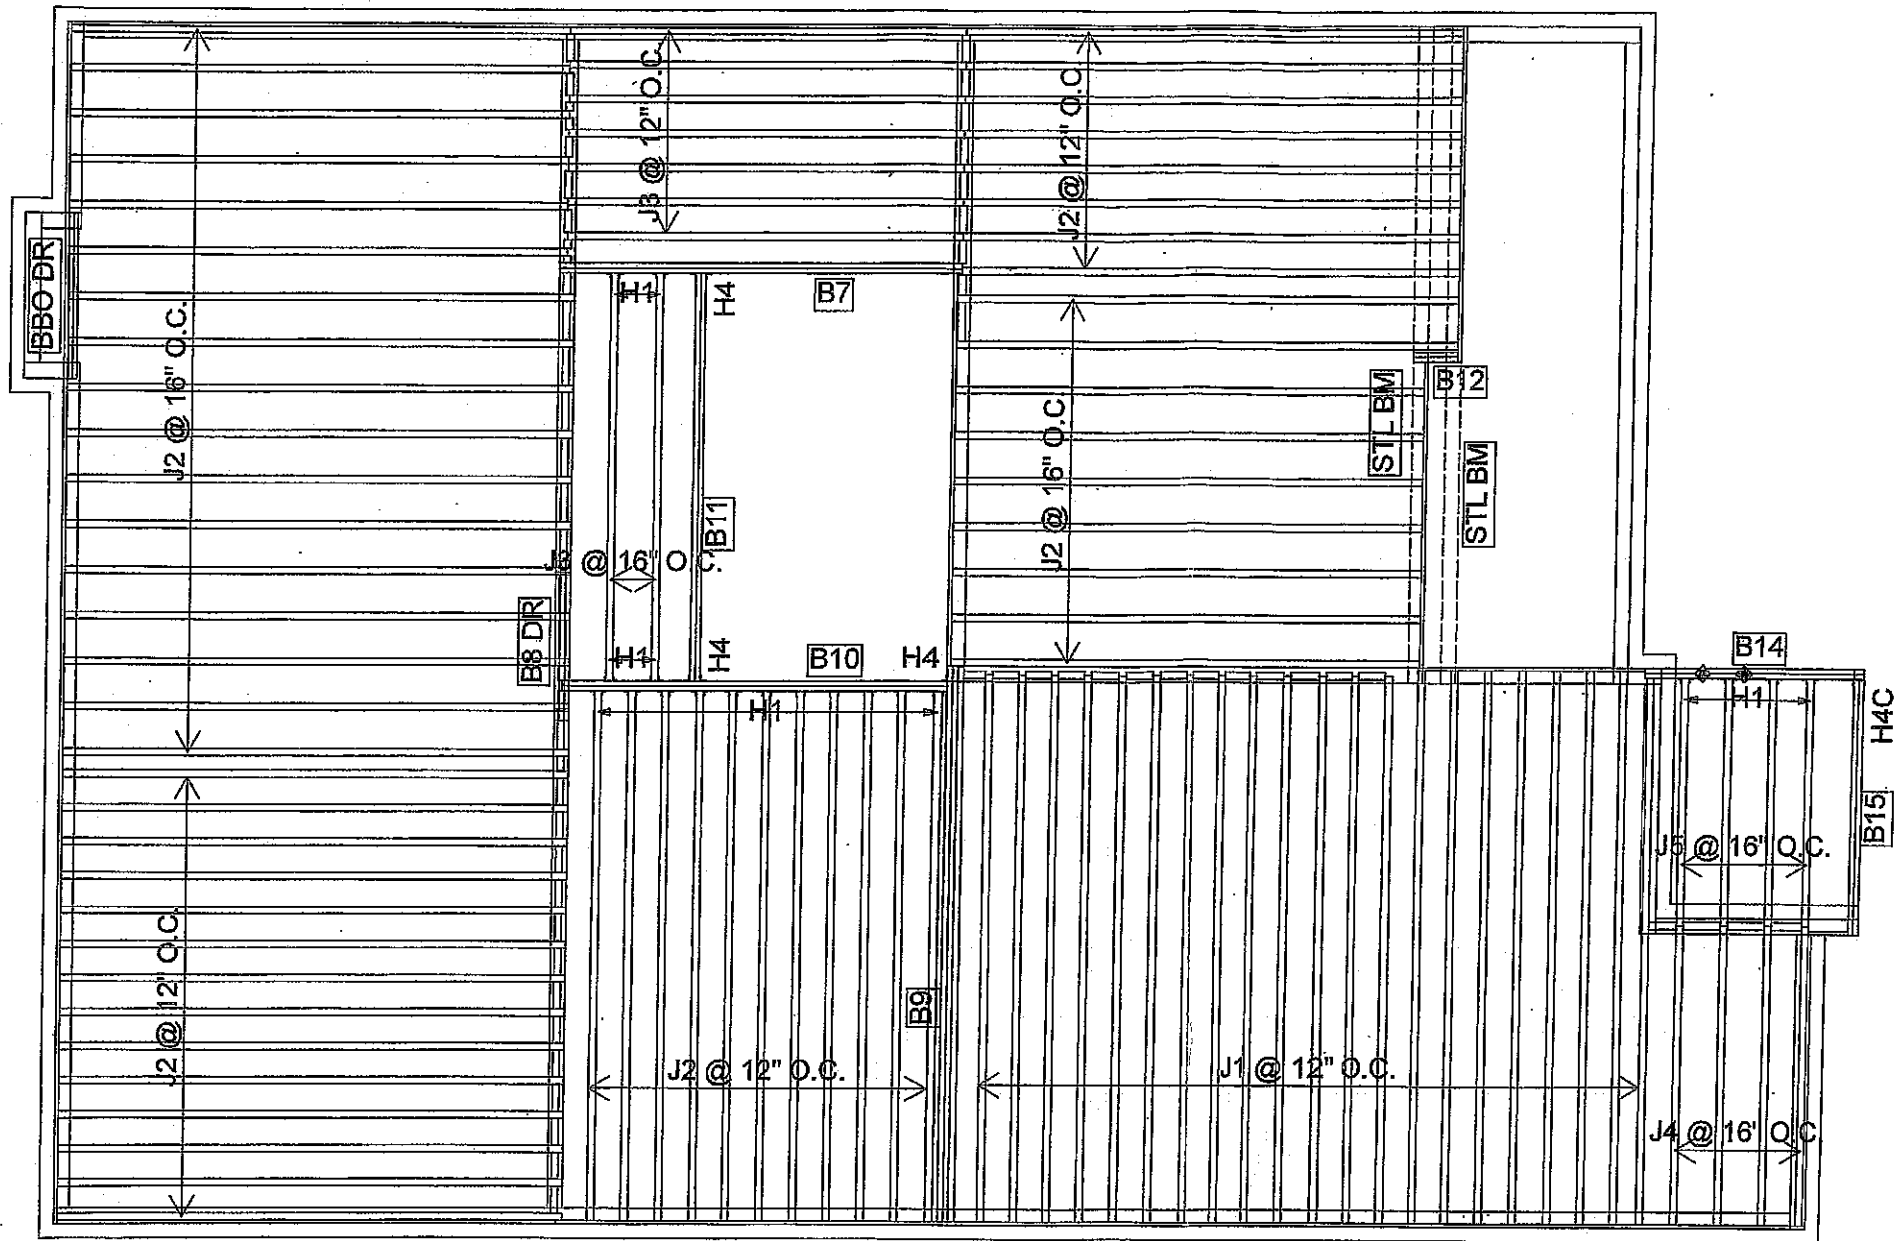

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
J1	18-00-00	9 1/2" NI-40x	1	21	MFD
J2	16-00-00	9 1/2" NI-40x	1	59	MFD
J3	12-00-00	9 1/2" NI-40x	1	9	MFD
J4	10-00-00	9 1/2" NI-40x	1	4	MFD
J5	8-00-00	9 1/2" NI-40x	1	4	MFD
B9	18-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	3	3	MFD
B10	12-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2	MFD
B11	12-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2	MFD
B7	12-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2	MFD
B14	8-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2	MFD
B15	8-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2	MFD

Connector Summary		
Qty	Manuf	Product
19	H1	IUS2.56/9.5
1	H4C	HUC410
2	H4	HGUS410
1	H4	HGUS410

CITY OF HAMILTON
Building Division
Permit No. 196110
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and specifications have been reviewed
JDC DEC 15 2020
For use on this project only DATE




FROM PLAN DATED:
BUILDER: GREENPARK HOMES
SITE: RUSSELL GARDENS PH 3
MODEL: MOUNTAINASH 3
ELEVATION: 1
LOT:
CITY: WATERDOWN
SALESMAN: MARIO DICIANO
DESIGNER: AJ
REVISION:
NOTES:
REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION. SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. MULTIPLE SQUASH BLOCKS REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. CANTILEVERED JOISTS INCLUDING CANT' OVER BRICK REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR HOLES INCLUDING DUCT CHASE AND FIELD CUT OPENINGS SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. CERAMIC TILE APPLICATION AS PER O.B.C. 9.30.6

LOADING:
DESIGN LOADS: L/480.000
LIVE LOAD: 40.0 lb/ft²
DEAD LOAD: 20.0 lb/ft²
SUBFLOOR: 5/8" GLUED AND NAILED

DATE: 2020-02-14

2nd FLOOR
OPTION 5 BEDROOM

OCT 05 2020

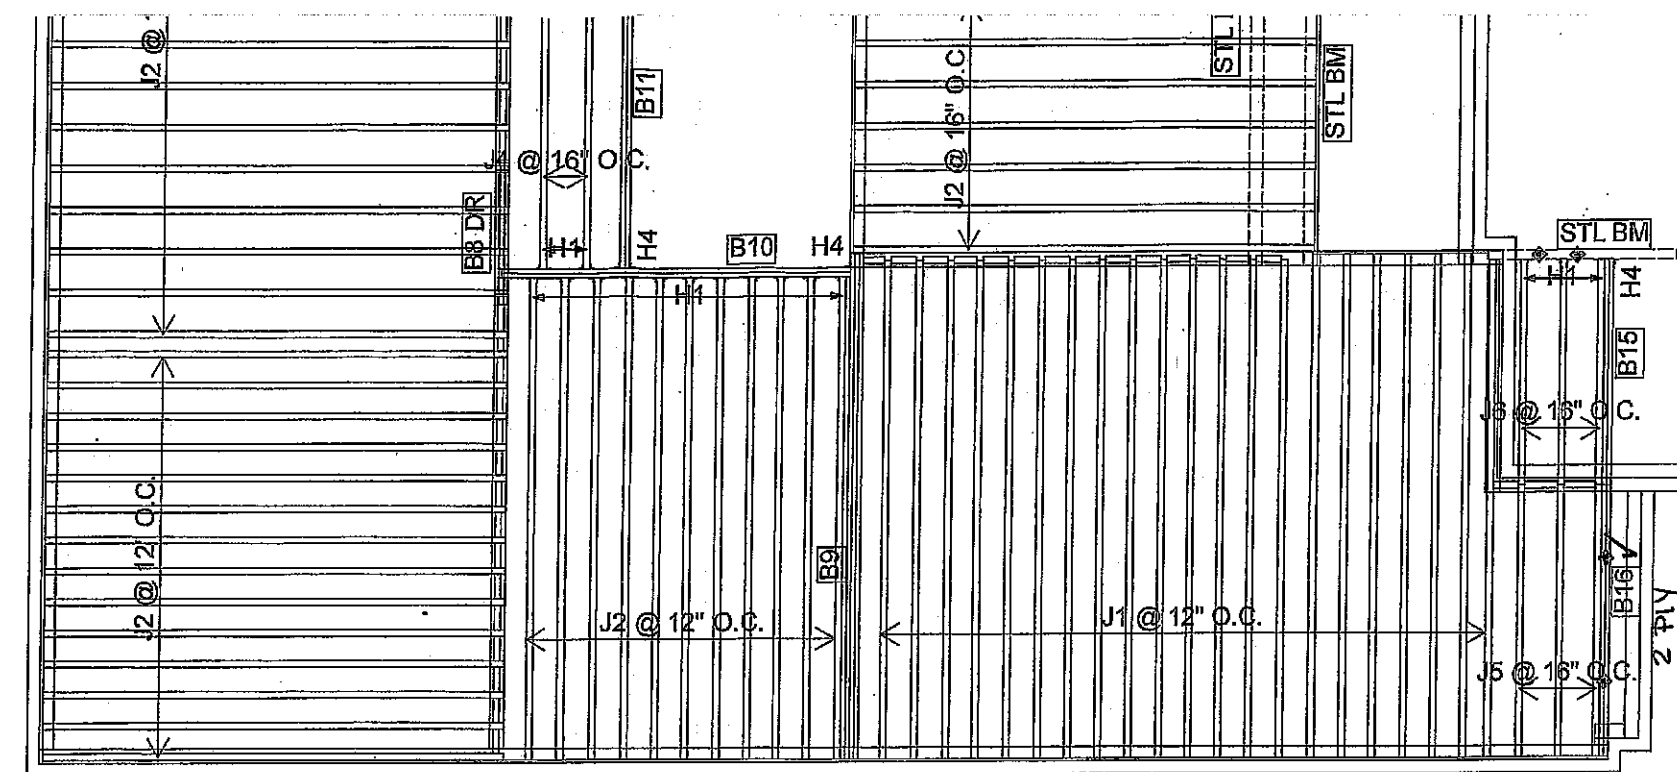REC BY _____ DATE _____
REF'D TO _____ DATE _____

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
J1	18-00-00	9 1/2" NI-40x	1	21	MFD
J2	16-00-00	9 1/2" NI-40x	1	49	MFD
J3	14-00-00	9 1/2" NI-40x	1	8	MFD
J4	12-00-00	9 1/2" NI-40x	1	9	MFD
J5	10-00-00	9 1/2" NI-40x	1	3	MFD
J6	8-00-00	9 1/2" NI-40x	1	3	MFD
B9	18-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3	MFD
B10	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B11	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B7	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B16	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B15	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B8 DR	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3	MFD
B12B	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD

Connector Summary		
Qty	Manuf	Product
15	H1	IUS2.56/9.5
3	H1	IUS2.56/9.5
2	H4	HGUS410
1	H4	HGUS410
1	H4	HGUS410

CITY OF HAMILTON
Building Division

Permit No. 196110

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

JDL

DEC 15 2020

FOR CHIEF BUILDING OFFICIAL

DATE

ELEVA

LOT:


CITY: \

SALES
DESIGN
REVISIONNOTES:
REFER
GUIDE F
INSTALL
2x6, 2x8
UNIFORM
SQUASH
CONCENT
CANTILE
OVER B
BEARING
ENDS. S
REINFOR
HOLES I
CUT OF
THE APPLICALOADING
DESIGN
LIVE LO
DEAD L
SUBFLOO

DATE: 2

2nd

STD

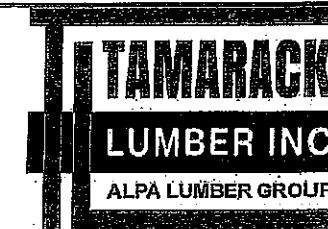

FROM PLAN DATED:

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS PH 3

MODEL: MOUNTAINASH 3

ELEVATION: 2

LOT:

CITY: WATERDOWN

SALESMAN: MARIO DICIANO

DESIGNER: AJ

REVISION:

NOTES:

REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION. SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. MULTIPLE SQUASH BLOCKS REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. CANTILEVERED JOISTS INCLUDING CANT' OVER BRICK REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR HOLES INCLUDING DUCT CHASE AND FIELD CUT OPENINGS SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. CERAMIC TILE APPLICATION AS PER O.B.C. 9.30.6

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²


DEAD LOAD: 20.0 lb/ft²

SUBFLOOR: 5/8" GLUED AND NAILED

DATE: 2020-02-14

2nd FLOOR

OPT 5 BEDROOM

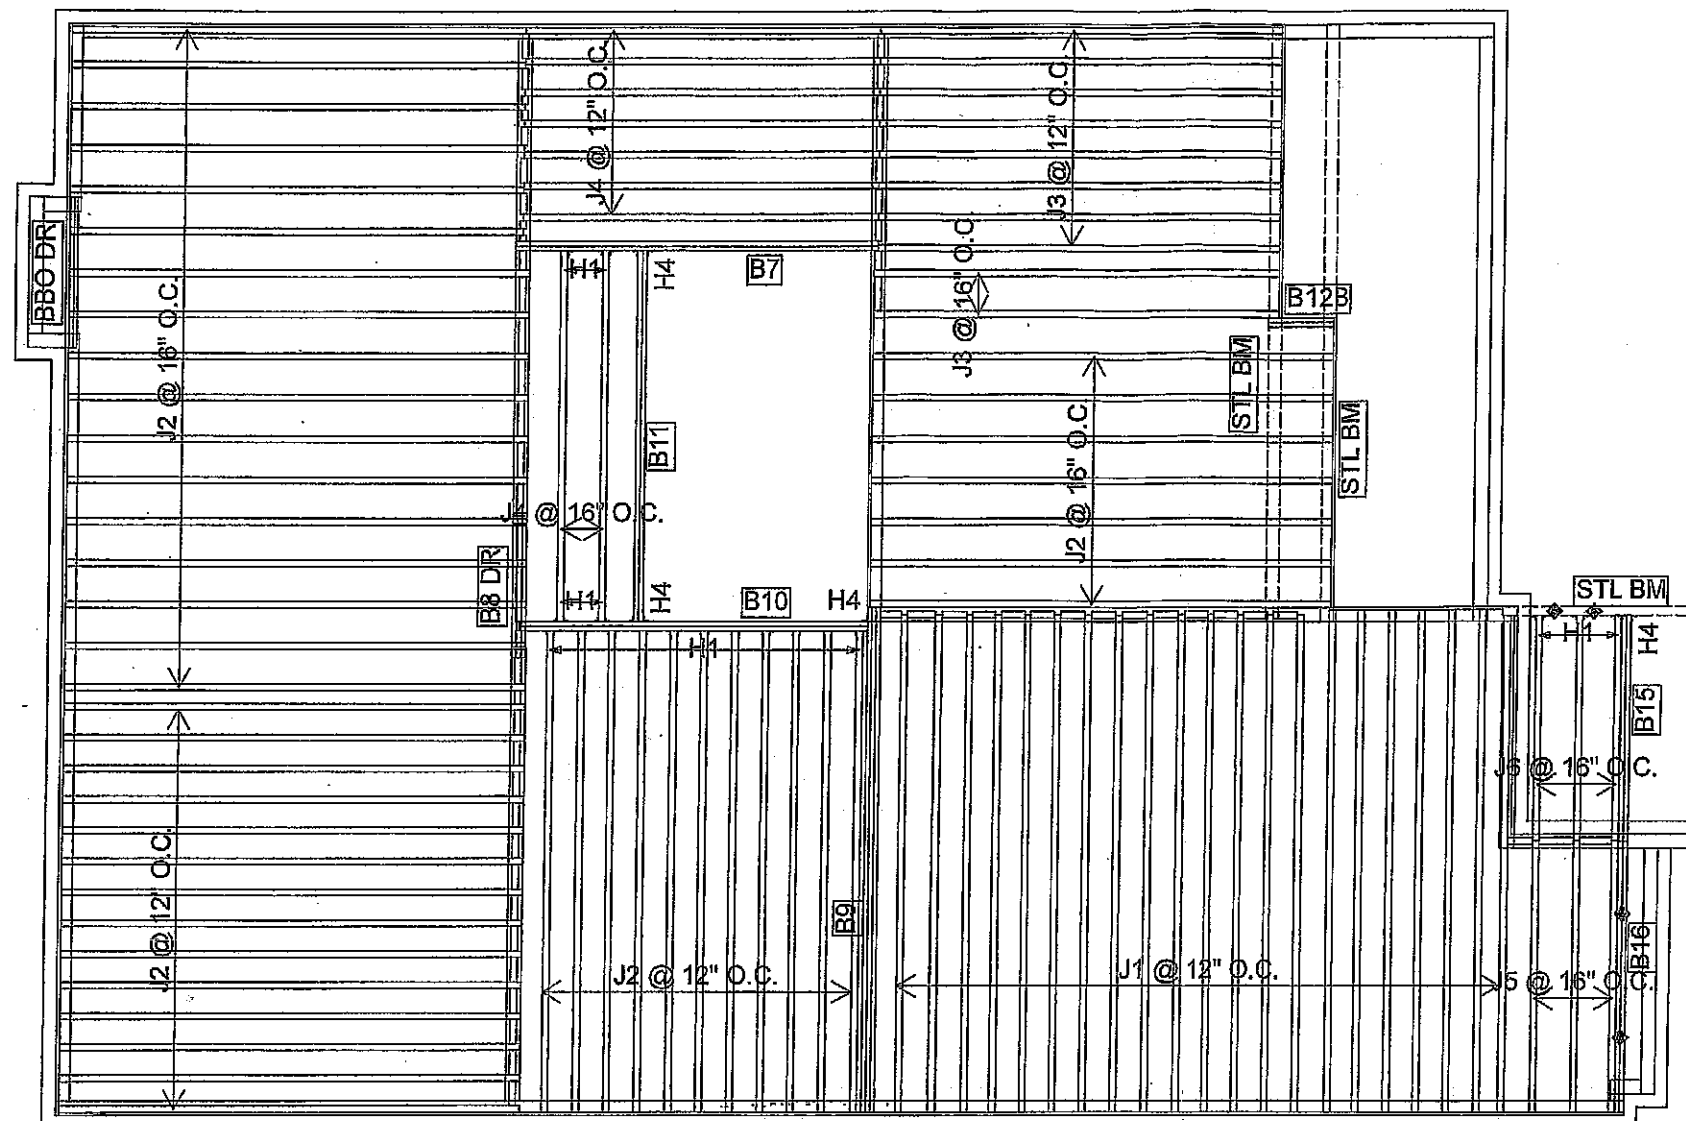

Products

PlotID	Length	Product	Plies	Net Qty	Fab Type
J1	18-00-00	9 1/2" NI-40x	1	21	MFD
J2	16-00-00	9 1/2" NI-40x	1	49	MFD
J3	14-00-00	9 1/2" NI-40x	1	10	MFD
J4	12-00-00	9 1/2" NI-40x	1	9	MFD
J5	10-00-00	9 1/2" NI-40x	1	3	MFD
J6	8-00-00	9 1/2" NI-40x	1	3	MFD
B9	18-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3	MFD
B10	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B11	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B7	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B16	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B15	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B8 DR	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3	MFD
B12B	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD

Connector Summary

Qty	Manuf	Product
15	H1	IUS2.56/9.5
3	H1	IUS2.56/9.5
2	H4	HGUS410
1	H4	HGUS410
1	H4	HGUS410

CITY OF HAMILTON
Building Division

Permit No. 196110

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW


These drawings and/or specifications have been reviewed by

JDC

FOR CHIEF BUILDING OFFICIAL

DATE

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department
OCT 16 2020
REC'DY DATE
REF'D TO DATE

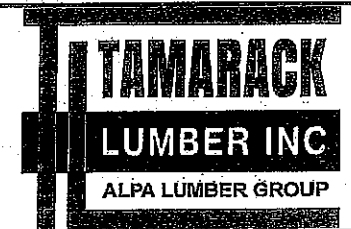

FROM PLAN DATED:

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS PH 3

MODEL: MOUNTAINASH 3

ELEVATION: 3

LOT:

CITY: WATERDOWN

SALESMAN: MARIO DICIANO

DESIGNER: AJ

REVISION:

NOTES:

REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²


DEAD LOAD: 20.0 lb/ft²

SUBFLOOR: 5/8" GLUED AND NAILED

DATE: 2020-02-14

2nd FLOOR

STD

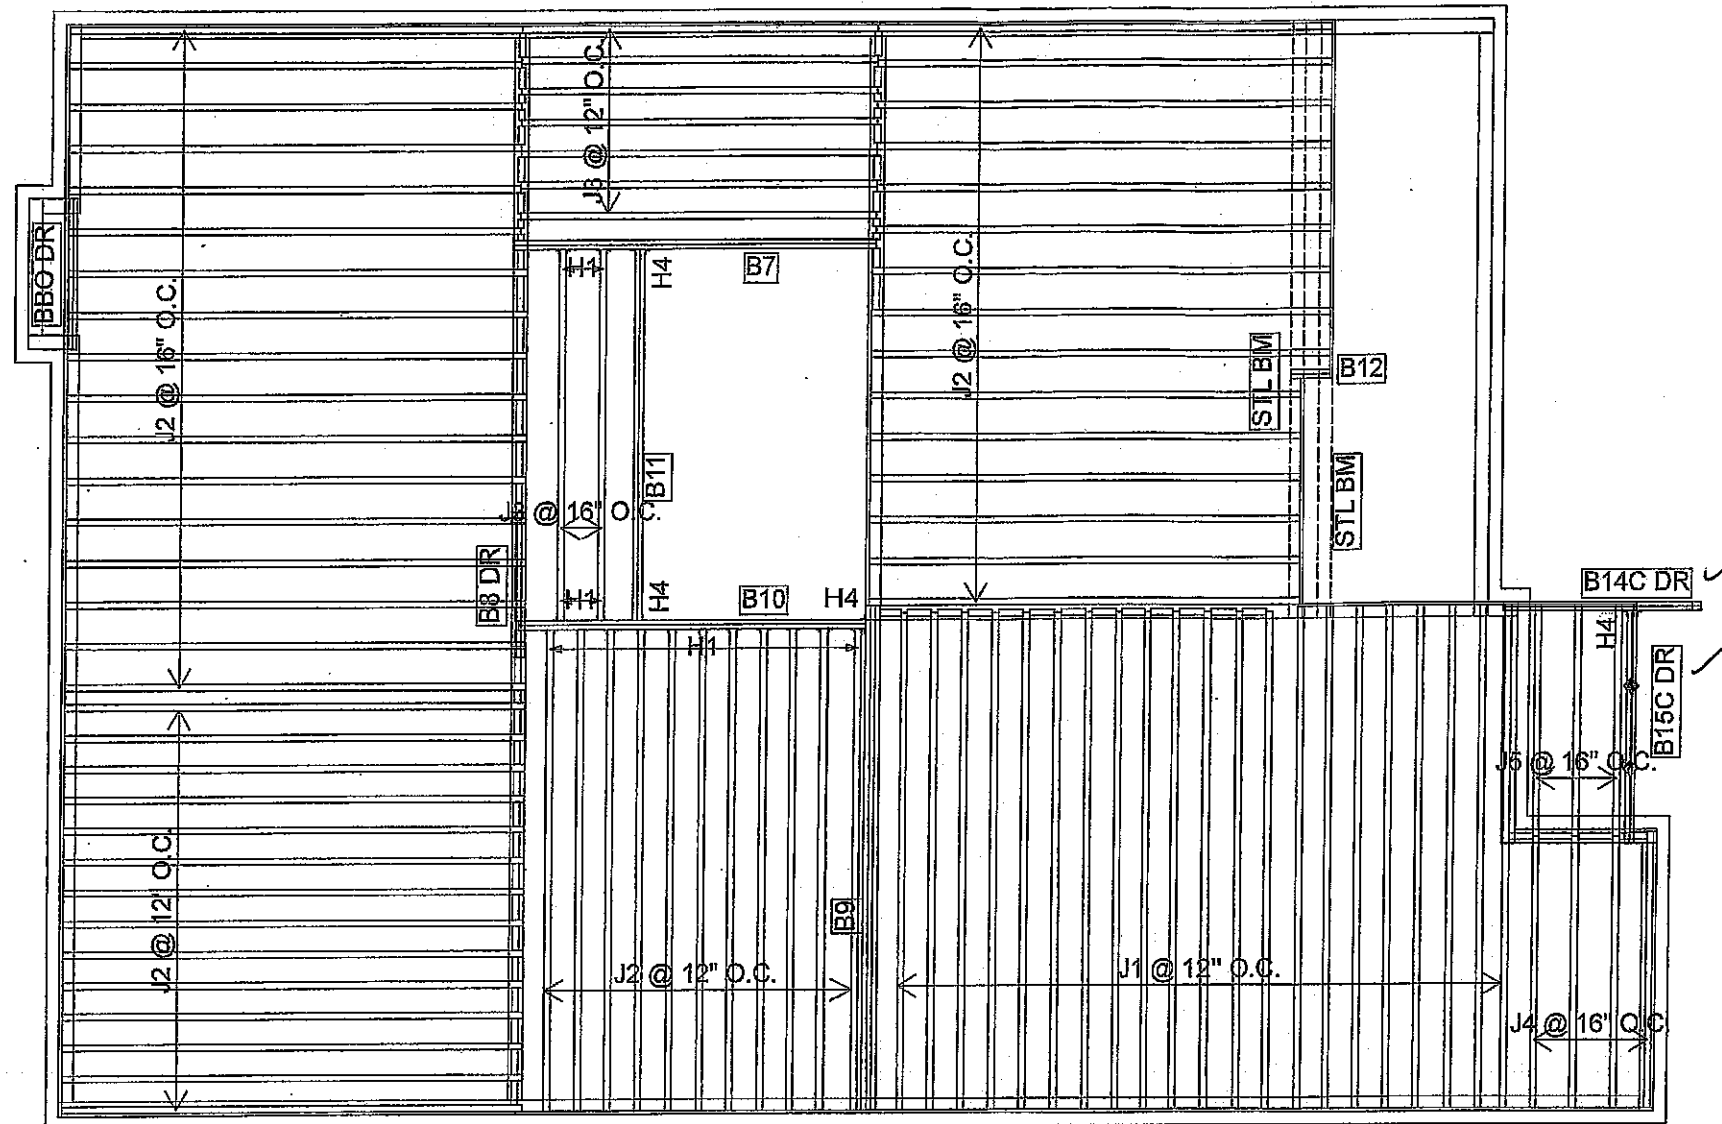

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
J1	18-00-00	9 1/2" NI-40x	1	21	MFD
J2	16-00-00	9 1/2" NI-40x	1	57	MFD
J3	12-00-00	9 1/2" NI-40x	1	9	MFD
J4	10-00-00	9 1/2" NI-40x	1	4	MFD
J5	8-00-00	9 1/2" NI-40x	1	3	MFD
B9	18-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	3	3	MFD
B10	12-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2	MFD
B11	12-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2	MFD
B7	12-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2	MFD
B14C DR	8-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2	MFD
B15C DR	8-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2	MFD
B8 DR	6-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	3	3	MFD
B12	2-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2	MFD

Connector Summary		
Qty	Manuf	Product
15	H1	IUS2.56/9.5
3	H4	HGUS410
1	H4	HGUS410

CITY OF HAMILTON
Building Division
196110

Permit No.

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by
DEC 15 2020


FOR CHIEF BUILDING OFFICIAL

DATE

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department

OCT 06 2020

REC BY _____ DATE _____
REFD TO _____ DATE _____

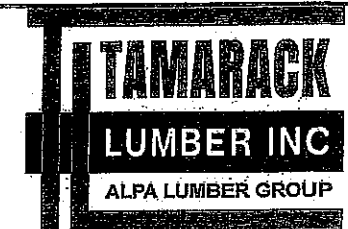

FROM PLAN DATED:

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS PH 3

MODEL: MOUNTAINASH 3

ELEVATION: 3

LOT:

CITY: WATERDOWN

SALESMAN: MARIO DICIANO

DESIGNER: AJ

REVISION:

NOTES:

REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²


DEAD LOAD: 20.0 lb/ft²

SUBFLOOR: 5/8" GLUED AND NAILED

DATE: 2020-02-14

2nd FLOOR

OPT 5 BEDROOM

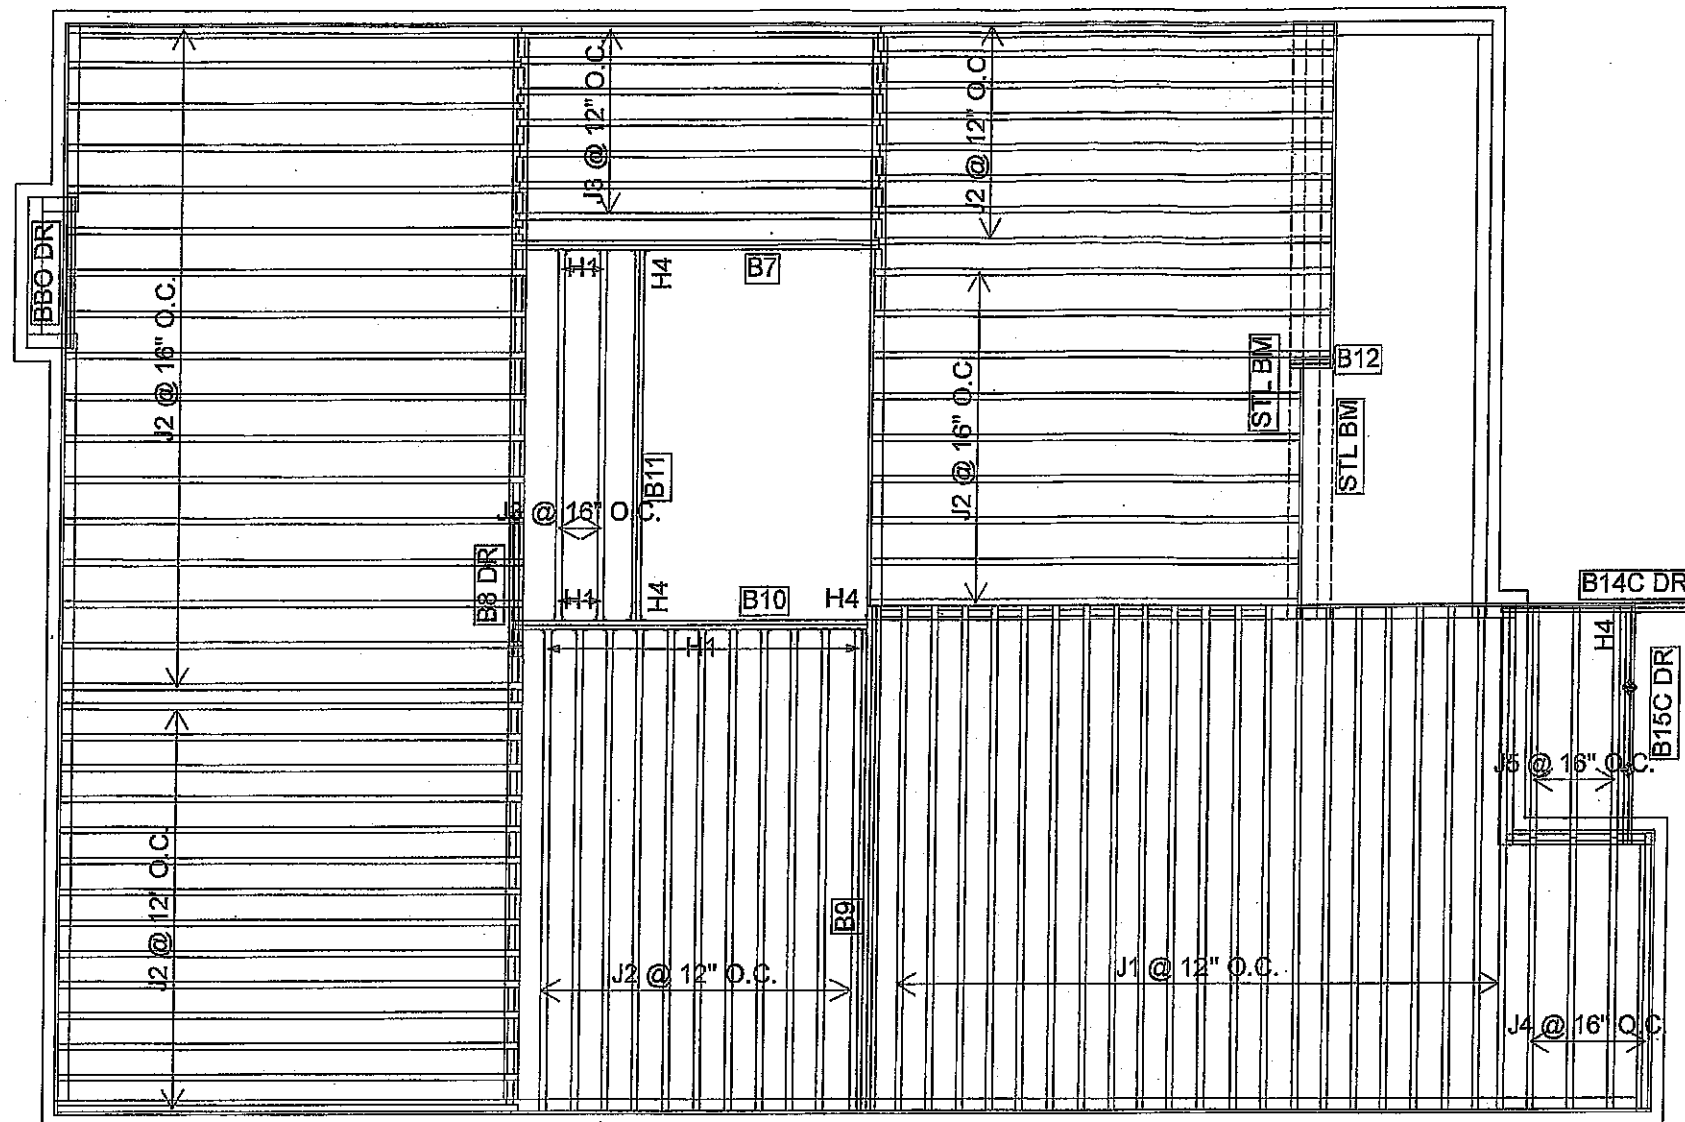

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
J1	18-00-00	9 1/2" NI-40x	1	21	MFD
J2	16-00-00	9 1/2" NI-40x	1	59	MFD
J3	12-00-00	9 1/2" NI-40x	1	9	MFD
J4	10-00-00	9 1/2" NI-40x	1	4	MFD
J5	8-00-00	9 1/2" NI-40x	1	3	MFD
B9	18-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	3	3	MFD
B10	12-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2	MFD
B11	12-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2	MFD
B7	12-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2	MFD
B14C DR	8-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2	MFD
B15C DR	8-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2	MFD
B8 DR	6-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	3	3	MFD
B12	2-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2	MFD

Connector Summary		
Qty	Manuf	Product
15	H1	IUS2.56/9.5
3	H4	HGUS410
1	H4	HGUS410

CITY OF HAMILTON
Building Division

Permit No. 196110

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

JDC

FOR CHIEF BUILDING OFFICIAL


DEC 15 2020

DATE

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department

OCT 16 2020

REC BY _____ DATE _____
REF'D TO _____ DATE _____

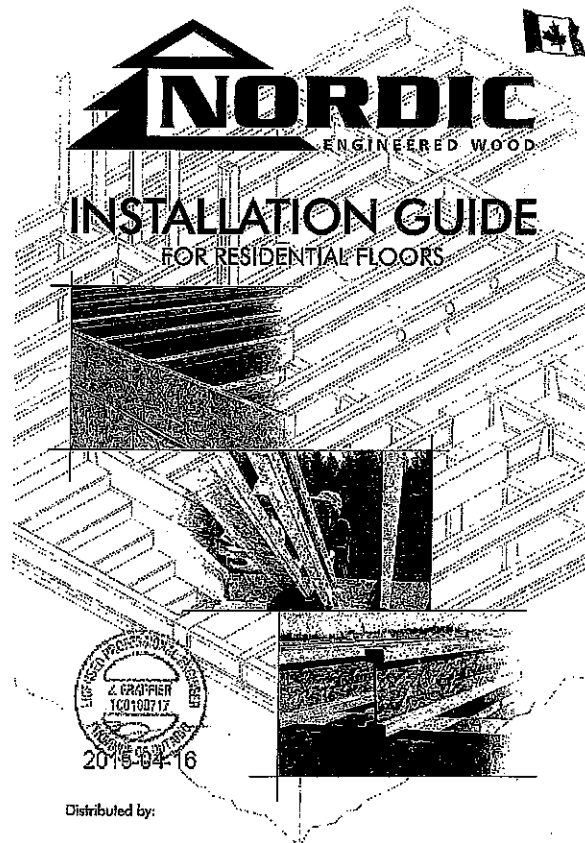

SAFETY AND CONSTRUCTION PRECAUTIONS



WARNING

I-joists are not stable until completely installed, and will not carry any load until fully braced and sheathed.


Avoid Accidents by Following these Important Guidelines:

1. Stairs and not end I-joist as it is installed, using hangers, blocking panels, rim board, and/or cross-bracing at joist ends. When I-joists are applied continuous over interior supports and a load-bearing wall is planned at that location, blocking will be required at the interior support.
2. When the building is completed, the floor sheathing will provide lateral support for the top flanges of the I-joists. Until this sheathing is applied, temporary bracing, often called struts, or temporary sheathing must be applied to prevent I-joist rollover or buckling.
 - Temporary bracing or struts must be 1x4 inch minimum, at least 8 feet long and spaced no more than 8 feet on centre, and must be secured with a minimum of two 2-1/2" nails fastened to the top surface of each I-joist. Nail the bracing to a lateral restraint at the end of each bay. Lap ends of adjoining bracing over at least two I-joists.
 - Or sheathing (temporary or permanent) can be nailed to the top flange of the first & last I-joist at the end of the bay.
3. For cantilevered I-joists, brace top and bottom flanges, and brace ends with closure panels, rim board, or cross-bracing.
4. Install and fully nail permanent sheathing to each I-joist before placing loads on the floor system. Then, stack building materials over beams or walls only.
5. Never install a damaged I-joist.

Improper storage or installation, failure to follow applicable building codes, failure to follow span ratings for Nordic I-joists, failure to follow allowable hole sizes and locations, or failure to use web stiffeners when required can result in serious accidents. Follow these installation guidelines carefully.

STORAGE AND HANDLING GUIDELINES

1. Bundles wrap can be slippery when wet. Avoid walking on wrapped bundles.
2. Store, stack, and handle I-joists vertically and level only.
3. Always stack and handle I-joists in the upright position only.
4. Do not store I-joists in direct contact with the ground and/or flatwise.
5. Protect I-joists from weather, and use spacers to separate bundles.
6. Bundled units should be kept lifted until time of installation.
7. When handling I-joists with a crane on the job site, take a few simple precautions to prevent damage to the I-joists and injury to your work crew.
 - Pick I-joists in bundles as shipped by the supplier.
 - Orient the bundles so that the webs of the I-joists are vertical.
 - Pick the bundles at the 5th points, using a spreader bar if necessary.
8. Do not handle I-joists in a horizontal orientation.
9. NEVER USE OR TRY TO REPAIR A DAMAGED I-JOIST.



MAXIMUM FLOOR SPANS

1. Maximum clear spans applicable to simple-span or multiple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration and a live load deflection limit of L/480. For multiple-span applications, the end spans shall be 40% or more of the adjacent span.
2. Spans are based on a composite floor with glued-sheathed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less, or 3/4 inch for joist spacing of 24 inches. Adhesive shall meet the requirements given in C308-71.26 Standard. No concrete topping or bridging element was assumed. Increased spans may be achieved with the use of gypsum and/or a row of blocking at mid-span.
3. Minimum bearing length shall be 1-3/4 inches for the end bearings, and 3-1/2 inches for the intermediate bearings.
4. Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
5. This span chart is based on uniform loads. For applications with other than uniform loads, an engineering analysis may be required based on the use of the design properties.
6. Tables are based on Limit States Design per CAN/CSA C308-09 Standard, and NSC 2010.
7. SI units conversion: 1 inch = 25.4 mm
1 foot = 0.305 m


MAXIMUM FLOOR SPANS FOR NORDIC I-JOISTS

Joist Depth	Joist Series	Simple spans				Multiple spans			
		On centre spacing	12"	16"	19.2"	On centre spacing	12"	16"	19.2"
9 1/2"	N1-20	15'1"	14'2"	13'9"	12'5"	16'3"	15'4"	14'10"	14'7"
	N1-40	18'1"	15'2"	14'3"	12'9"	17'5"	16'5"	15'10"	15'6"
	N1-60	18'9"	15'4"	14'10"	14'11"	17'7"	16'7"	15'12"	15'8"
	N1-70	17'1"	16'1"	15'6"	15'2"	16'7"	15'4"	14'9"	14'5"
	N1-80	12'3"	16'3"	15'8"	15'9"	16'10"	15'6"	14'11"	14'7"
11 7/8"	N1-20	16'11"	15'0"	13'5"	12'5"	18'4"	17'3"	16'8"	15'4"
	N1-40	18'1"	17'0"	16'5"	16'6"	20'0"	18'9"	18'0"	17'7"
	N1-60	18'4"	17'3"	16'7"	16'9"	20'3"	18'9"	18'0"	17'7"
	N1-70	19'6"	18'0"	17'4"	17'5"	21'6"	19'11"	19'0"	18'1"
	N1-80	19'9"	18'3"	17'4"	17'7"	21'9"	20'2"	19'3"	18'4"
	N1-90	20'2"	18'7"	17'10"	17'11"	22'3"	20'7"	19'8"	19'9"
	N1-90A	20'4"	18'9"	17'11"	18'0"	22'5"	20'9"	19'10"	19'11"
14"	N1-40	20'1"	18'7"	17'10"	17'11"	22'2"	20'5"	19'14"	19'4"
	N1-60	20'5"	18'11"	18'1"	18'2"	22'7"	20'11"	20'0"	20'1"
	N1-70	21'7"	20'0"	19'11"	19'2"	23'10"	21'11"	21'1"	21'2"
	N1-80	21'11"	20'3"	19'4"	19'5"	24'3"	22'5"	21'5"	21'6"
	N1-90	22'5"	20'6"	19'9"	19'10"	24'9"	22'10"	21'10"	21'10"
	N1-90A	22'7"	20'8"	19'11"	20'0"	25'0"	23'1"	22'0"	22'2"
16"	N1-40	22'5"	20'8"	19'9"	19'10"	24'7"	22'9"	21'9"	21'10"
	N1-60	23'8"	21'9"	20'9"	21'0"	25'0"	24'0"	23'11"	23'0"
	N1-80	23'11"	22'1"	21'2"	21'3"	26'0"	24'9"	23'9"	23'9"
	N1-90	24'5"	22'5"	21'5"	21'6"	26'11"	24'10"	23'9"	23'9"
	N1-90A	24'6"	22'6"	21'6"	21'7"	27'3"	25'2"	24'0"	24'1"

CMC EVALUATION REPORT 13037-R

I-JOIST HANGERS

1. Hangers shown illustrate the three most commonly used metal hangers to support I-joists.
2. All nailing must meet the hanger manufacturer's recommendations.
3. Hangers should be selected based on the joist depth, flange width and load capacity based on the maximum spans.
4. Web stiffeners are required when the sides of the hangers do not directly brace the top flange of the I-joist.



WEB STIFFENERS

RECOMMENDATIONS:


■ A bearing stiffener is required in all engineered applications with factored reactions greater than shown in the I-joist properties table found in the I-joist Construction Guide (C101). The gap between the stiffener and the flange is at the top.

■ A bearing stiffener is required when the I-joist is supported in a hanger and the sides of the hanger do not extend up to, and support, the top flange. The gap between the stiffener and the flange is at the top.

■ A load stiffener is required at locations where a factored concentrated load greater than 2,270 lbs is applied to the top flange between supports, or in the case of a cantilever, anywhere between the cantilever tip and the support. These values are for standard term load duration, and may be adjusted for other load durations as permitted by the code. The gap between the stiffener and the flange is at the bottom.

SI units conversion: 1 inch = 25.4 mm


FIGURE 2
WEB STIFFENER INSTALLATION DETAILS

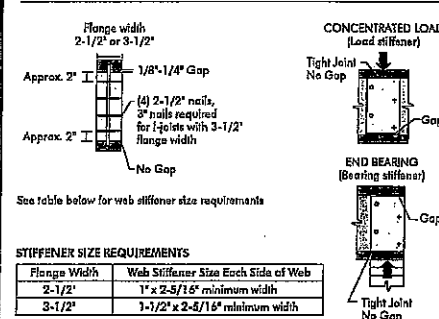





INSTALLING NORDIC I-JOISTS

1. Before laying out floor system components, verify that I-joist flange widths match hanger widths. If not, contact supplier.
2. Except for cutting to length, I-joist flanges should never be cut, drilled, or notched.
3. Install I-joists so that top and bottom flanges are within 1/2 inch of true vertical alignment.
4. I-joists must be anchored securely to supports before floor sheathing is attached, and supports for multiple-span joists must be level.
5. Minimum bearing lengths: 1-3/4 inches for end bearings and 3-1/2 inches for intermediate bearings.
6. When using hangers, seat I-joists firmly in hanger bottoms to minimize settlement.
7. Leave a 1/16-inch gap between the I-joist end and a header.
8. Concentrated loads greater than those that can normally be expected in residential construction should only be applied to the top surface of the top flange. Normal concentrated loads include track lighting fixtures, audio equipment and security cameras. Never suspend unusual or heavy loads from the I-joist's bottom flange. Whenever possible, suspend all concentrated loads from the top of the I-joist. Or, attach the load to blocking that has been securely fastened to the I-joist webs.
9. Never install I-joists where they will be permanently exposed to weather, or where they will remain in direct contact with concrete or masonry.
10. Restrain ends of floor joists to prevent raveling. Use rim board, rim joists or I-joist blocking panels.
11. For I-joists installed over and beneath bearing walls, use full depth blocking panels, rim board, or squish blocks (strips members) to transfer gravity loads through the floor system to the wall or foundation below.
12. Due to shrinkage, common framing lumber set on edge may never be used as blocking or rim boards. I-joist blocking panels or other engineered wood products—such as rim board—must be cut to fit between the I-joists, and an I-joist-compatible depth selected.
13. Provide permanent lateral support of the bottom flange of all I-joists at interior supports of multiple-span joists. Similarly, support the bottom flange of all cantilevered I-joists at the end support next to the cantilever extension. In the completed structure, the gypsum wallboard ceiling provides this lateral support. Until the final finished ceiling is applied, temporary bracing or struts must be used.
14. If square-edge panels are used, edges must be supported between I-joists with 2x4 blocking. Glue panels to blocking to minimize squeaks. Blocking is not required under structural finish flooring, such as wood strip flooring, or if a separate underlayment layer is installed.
15. Nail spacing: Space nails installed to the flange's top face in accordance with the applicable building code requirements or approved building plans.

FIGURE 1
TYPICAL NORDIC I-JOIST FLOOR FRAMING AND CONSTRUCTION DETAILS

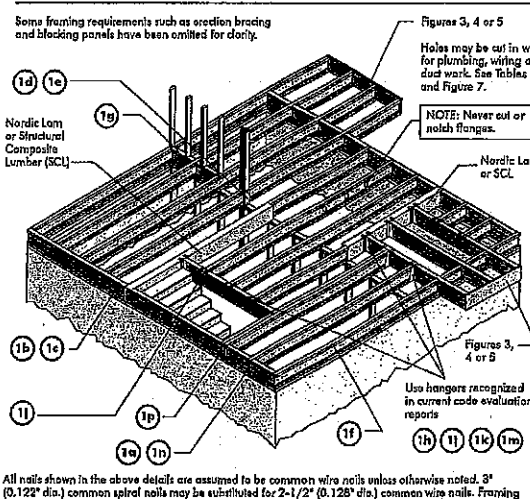

All nails shown in the above details are assumed to be common wire nails unless otherwise noted. 3" (0.122" dia.) common spiral nails may be substituted for 2-1/2" (0.128" dia.) common wire nails. Framing lumber assumed to be Spruce-Pine-Fir No. 2 or better. Individual components not shown to scale for clarity.

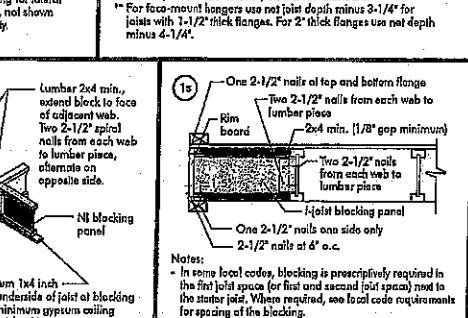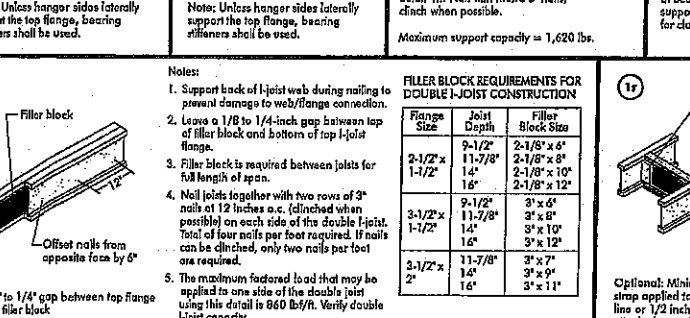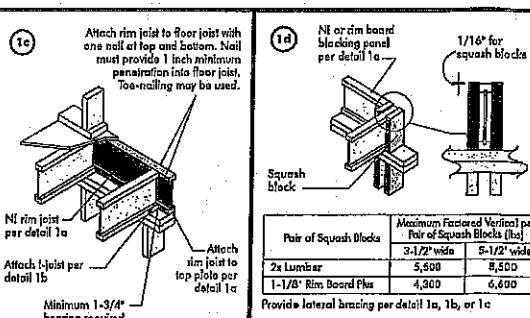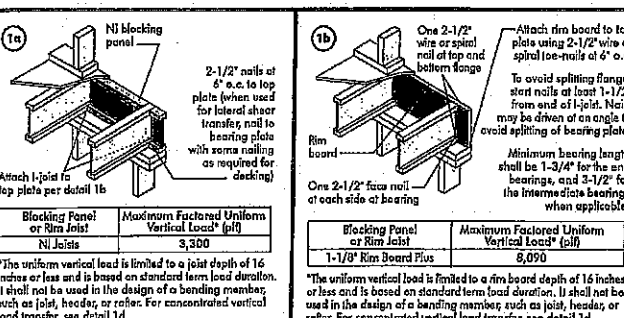

*The uniform vertical load is limited to a joist depth of 16 inches or less and is based on standard term load duration. It shall not be based on the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

*The uniform vertical load is limited to a rim board depth of 16 inches or less and is based on standard term load duration. It shall not be based on the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

*The uniform vertical load is limited to a joist depth of 16 inches or less and is based on standard term load duration. It shall not be based on the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

*The uniform vertical load is limited to a joist depth of 16 inches or less and is based on standard term load duration. It shall not be based on the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.



Refer to the Installation Guide for Residential Floors for additional information.
CCMC EVALUATION REPORT 13032-R

WEB HOLE SPECIFICATIONS

RULES FOR CUTTING HOLES AND DUCT CHASE OPENINGS:

- The distance between the inside edge of the support and the centreline of any hole or duct chase opening shall be in compliance with the requirements of Table 1 or 2, respectively.
- Hole top and bottom flanges must NEVER be cut, notched, or otherwise modified.
- Whenever possible, field-cut holes should be centred on the middle of the web.
- The maximum size hole or the maximum depth of a duct chase opening that can be cut into a joist web shall equal the clear distance between the flanges of the joist minus 1/4 inch. A minimum of 1/8 inch should always be maintained between the top or bottom of the hole or opening and the adjacent I-joist flange.

- The sides of square holes or longest sides of rectangular holes should not exceed 3/4 of the diameter of the maximum round hole permitted at that location.
- Where more than one hole is necessary, the distance between adjacent hole edges shall exceed twice the diameter of the largest round hole or twice the size of the largest square hole (or twice the length of the longest side of the largest rectangular hole or duct chase opening) and each hole and duct chase opening shall be sized and located in compliance with the requirements of Tables 1 and 2, respectively.
- A knockout is not considered a hole, may be utilized anywhere it occurs, and may be ignored for purposes of calculating minimum distances between holes and/or duct chase openings.
- Holes measuring 1-1/2 inches or smaller are permitted anywhere in a cantilevered section of a joist. Holes of greater size may be permitted subject to verification.

- A 1-1/2 inch hole or smaller can be placed anywhere in the web provided that it meets the requirements of rule number 6 above.
- All holes and duct chase openings shall be cut in a workman-like manner in accordance with the restrictions listed above and as illustrated in Figure 7.
- Limit three maximum size holes per span, of which one may be a duct chase opening.
- A group of round holes of approximately the same location shall be permitted if they meet the requirements for a single round hole circumscribed around them.

TABLE 1
LOCATION OF CIRCULAR HOLES IN JOIST WEBS
Simple or Multiple Span for Dead Loads up to 15 psf and Live Loads up to 40 psf

Joist Depth	Joist Series	Minimum Distance from Inside Face of Any Support to Centre of Hole (ft - in.)											
		Round Hole Diameter (in.)											
		2	3	4	5	6-1/4	7	8	8-5/8	9	10	10-3/4	11
9-1/2"	NI-20	0-7"	1-6"	2-10"	4-3"	5-8"	6-0"	---	---	---	---	---	---
	NI-40x	0-7"	1-6"	3-0"	4-4"	6-0"	6-4"	---	---	---	---	---	---
	NI-60	1-3"	2-6"	4-0"	5-4"	7-0"	7-5"	---	---	---	---	---	---
	NI-70	2-0"	3-4"	4-9"	6-3"	8-0"	8-4"	---	---	---	---	---	---
	NI-80	2-3"	3-6"	5-0"	6-4"	8-2"	8-8"	---	---	---	---	---	---
11-7/8"	NI-20	0-7"	0-8"	1-0"	2-4"	3-8"	4-0"	5-0"	6-5"	7-9"	---	---	---
	NI-40x	0-7"	0-8"	1-3"	2-8"	4-0"	4-4"	5-5"	7-0"	8-4"	---	---	---
	NI-60	0-7"	1-8"	3-0"	4-3"	5-9"	6-0"	7-3"	8-10"	10-0"	---	---	---
	NI-70	1-3"	2-6"	4-0"	5-4"	6-9"	7-2"	8-4"	10-0"	11-2"	---	---	---
	NI-80	1-6"	2-10"	4-0"	5-4"	7-0"	7-5"	8-5"	10-3"	11-4"	---	---	---
14"	NI-20	0-7"	0-8"	1-5"	3-2"	4-10"	5-4"	6-9"	8-9"	10-2"	---	---	---
	NI-40x	0-7"	0-8"	0-9"	2-5"	4-4"	4-9"	6-3"	---	---	---	---	---
	NI-60	0-7"	0-8"	1-8"	3-0"	4-3"	4-8"	5-8"	7-2"	8-0"	8-8"	10-2"	---
	NI-70	0-8"	1-10"	3-0"	4-5"	5-10"	6-2"	7-3"	8-9"	9-9"	10-4"	12-0"	---
	NI-80	0-10"	2-0"	3-4"	4-8"	6-2"	6-5"	7-8"	9-0"	10-0"	10-8"	12-4"	---
16"	NI-20	0-7"	0-8"	0-10"	2-5"	4-0"	4-5"	5-9"	7-3"	8-3"	9-4"	11-1"	---
	NI-40x	0-7"	0-8"	0-8"	2-0"	3-9"	4-2"	5-5"	7-3"	8-5"	9-2"	---	---
	NI-60	0-7"	0-8"	0-8"	1-6"	2-10"	3-2"	4-8"	5-8"	6-4"	7-0"	8-5"	9-9"
	NI-70	0-7"	1-0"	2-3"	3-6"	4-10"	5-3"	6-3"	7-8"	8-8"	9-12"	10-8"	12-0"
	NI-80	0-7"	1-3"	2-6"	3-10"	5-3"	5-6"	6-6"	8-0"	9-0"	9-5"	11-0"	12-3"



- Above table may be used for I-joist spacing of 24 inches on centre or less.
- Hole location distance is measured from inside face of supports to centre of hole.
- Distances in this chart are based on uniformly loaded joists.
- The above table is based on the I-joists being used at their maximum spans. The minimum distance as given above may be reduced for shorter spans; contact your local distributor.

TABLE 2
DUCT CHASE OPENING SIZES AND LOCATIONS
Simple Span Only

Joist Depth	Joist Series	Minimum distance from inside face of supports to centre of opening (ft - in.)											
		Duct Chase Length (in.)											
		8	10	12	14	16	18	20	22	24			
9-1/2"	NI-20	4-1"	4-5"	4-10"	5-4"	5-8"	6-1"	6-6"	7-1"	7-5"			
	NI-40x	5-3"	5-8"	6-0"	6-4"	6-10"	7-3"	7-8"	8-2"	8-6"			
	NI-60	5-4"	5-9"	6-2"	6-7"	7-1"	7-5"	8-0"	8-3"	8-9"			
	NI-70	5-1"	5-5"	5-10"	6-3"	6-7"	7-1"	7-6"	8-1"	8-4"			
	NI-80	5-3"	5-8"	6-0"	6-5"	6-10"	7-3"	7-8"	8-2"	8-6"			
11-7/8"	NI-20	5-9"	6-2"	6-6"	6-1"	7-1"	7-4"	7-9"	8-3"	8-9"	9-4"		
	NI-40x	6-8"	7-2"	7-6"	8-1"	8-6"	9-1"	9-6"	10-1"	10-5"			
	NI-60	7-5"	7-8"	8-0"	8-6"	9-0"	9-3"	9-9"	10-3"	10-7"			
	NI-70	7-1"	7-4"	7-9"	8-3"	8-7"	9-1"	9-6"	10-1"	10-5"			
	NI-80	7-2"	7-7"	8-0"	8-5"	8-10"	9-3"	9-8"	10-2"	10-8"			
14"	NI-20	7-6"	7-11"	8-4"	8-9"	9-2"	9-7"	10-1"	10-7"	10-11"			
	NI-40x	7-7"	8-1"	8-5"	8-10"	9-4"	9-8"	10-2"	10-8"	11-2"			
	NI-60	8-1"	8-7"	9-0"	9-6"	10-1"	10-7"	11-2"	12-0"	12-5"			
	NI-70	8-9"	9-3"	9-8"	10-1"	10-6"	11-1"	11-6"	12-3"	12-8"			
	NI-80	8-7"	9-1"	9-5"	9-10"	10-4"	10-8"	11-3"	11-7"	12-3"			
16"	NI-20	9-0"	9-5"	9-9"	10-1"	10-6"	11-1"	11-6"	12-1"	12-6"			
	NI-40x	9-2"	9-6"	10-0"	10-4"	10-8"	11-3"	11-8"	12-3"	12-8"			
	NI-60	10-3"	10-8"	11-2"	11-6"	12-1"	12-6"	13-1"	13-6"	14-1"			
	NI-70	10-1"	10-5"	11-0"	11-4"	11-9"	12-3"	12-8"	13-3"	13-8"			
	NI-80	10-4"	10-9"	11-3"	11-8"	12-1"	12-6"	13-1"	13-6"	14-1"			

- Above table may be used for I-joist spacing of 24 inches on centre or less.
- Duct chase opening location distance is measured from inside face of supports to centre of opening.
- The above table is based on simple-span joists only. For other applications, contact your local distributor.
- Distances are based on uniformly loaded floor joists that meet the span requirements for a design live load of 40 psf and dead load of 15 psf, and a load deflection limit of L/480.
- The above table is based on the I-joists being used at their maximum spans. The minimum distance as given above may be reduced for shorter spans; contact your local distributor.

FIGURE 7
FIELD-CUT HOLE LOCATOR

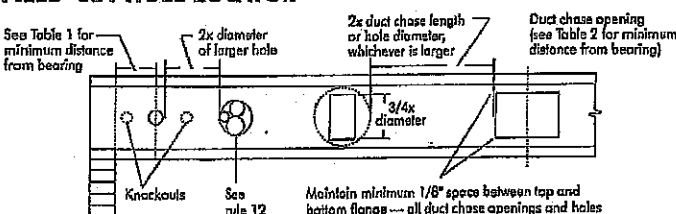

Knockouts are pre-scored holes provided for the contractor's convenience to install electrical or small plumbing lines. They are 1-1/2 inches in diameter, and are spaced 15 inches on centre along the length of the joist. Where possible, it is preferable to use knockouts instead of field-cut holes.

Never drill, cut or notch the flange, or over-cut the web.

Holes in webs should be cut with a sharp saw.

For rectangular holes, avoid over-cutting the corners, as this can cause unnecessary stress concentrations. Slightly rounding the corners is recommended. Starting the rectangular hole by drilling a 1-inch diameter hole in each of the four corners and then making the cuts between the holes is another good method to minimize damage to the I-joist.

SAFETY AND CONSTRUCTION PRECAUTIONS



Do not walk on I-joists until fully fastened and braced, or serious injuries can result.



Never stack building materials over unsecured I-joists. Once sheathed, do not over-stress I-joists with concentrated loads from building materials.

WARNING: I-joists are not stable until completely installed, and will not carry any load until fully braced and sheathed.

AVOID ACCIDENTS BY FOLLOWING THESE IMPORTANT GUIDELINES:

- Brace and nail each I-joist as it is installed, using hangers, blocking panels, rim board, and/or cross-briding at joist ends. When I-joists are applied continuous over interior supports and a load-bearing wall is planned at that location, blocking will be required at the interior support.
- When the building is completed, the floor sheathing will provide lateral support for the top flanges of the I-joists. Until this sheathing is applied, temporary bracing, often called struts, or temporary sheathing must be applied to prevent I-joist rollover or buckling.
- Temporary bracing or struts must be 1x4 inch minimum, at least 8 feet long and spaced no more than 8 feet on centre, and must be secured with a minimum of two 2-1/2" nails fastened to the top surface of each I-joist. Nail the bracing to a lateral restraint at the end of each bay. Lap ends of adjoining bracing over at least two I-joists.
- On sheathing (temporary or permanent) can be nailed to the top flange of the first 4 feet of I-joists at the end of the bay.
- For cantilevered I-joists, brace top and bottom flanges, and brace ends with closure panels, rim board, or cross-briding.
- Install and fully nail permanent sheathing to each I-joist before placing loads on the floor system. Then, stack building materials over beams or walls only.
- Never install a damaged I-joist.













Improper storage or installation, failure to follow applicable building codes, failure to follow span ratings for Nordic I-joists, failure to follow allowable hole sizes and locations, or failure to use web stiffeners when required can result in serious accidents. Follow these installation guidelines carefully.



PRODUCT WARRANTY

Chambers Chibogwanau guarantees that, in accordance with our specifications, Nordic products are free from manufacturing defects in material and workmanship.

Furthermore, Chambers Chibogwanau warrants that our products, when utilized in accordance with our handling and installation instructions, will meet or exceed our specifications for the lifetime of the structure.

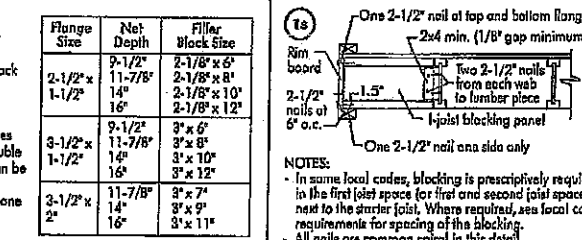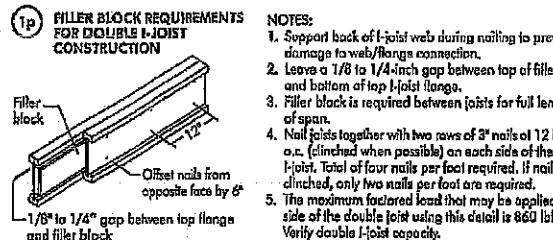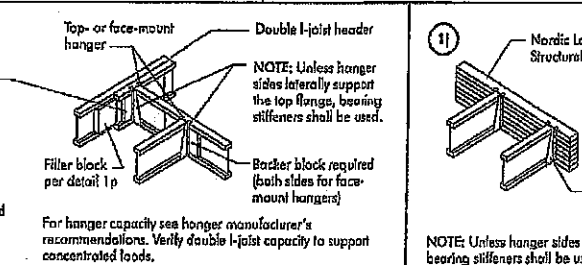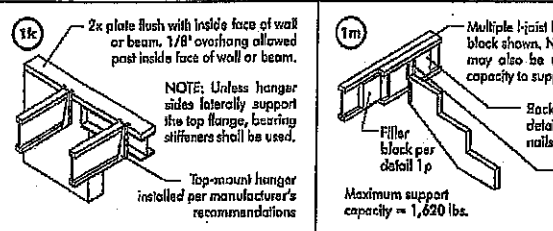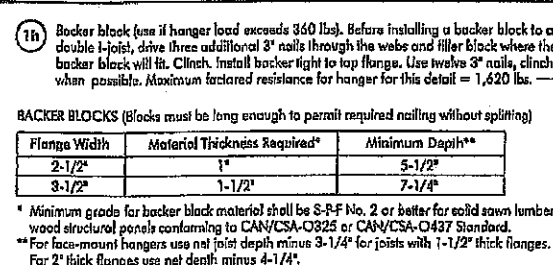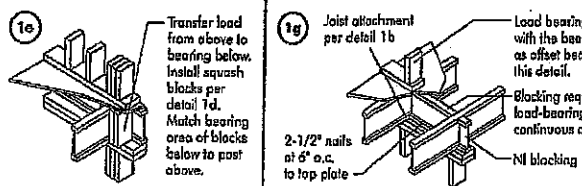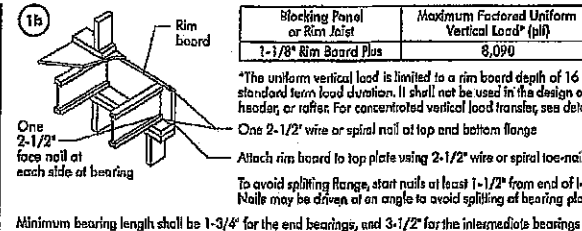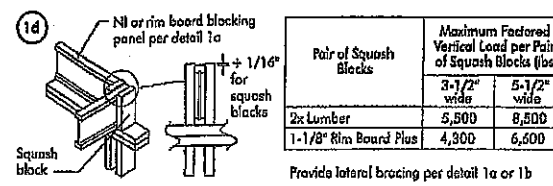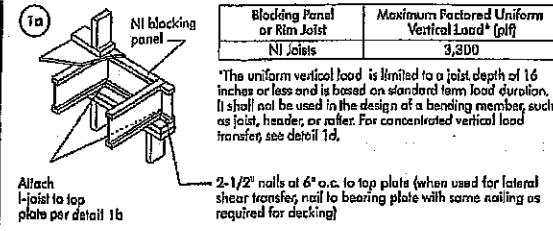


WEB STIFFENERS


RECOMMENDATIONS:

- A bearing stiffener is required in all engineered applications with factored reactions greater than shown in the I-joist properties table found in the Joist Construction Guide (C101). The gap between the stiffener and the flange is at the top.
- A bearing stiffener is required when the I-joist is supported in a hanger and the sides of the hanger do not extend up to, and support, the top flange. The gap between the stiffener and flange is at the top.
- A head stiffener is required at locations where a factored concentrated load greater than 2,370 lbs is applied to the top flange between supports, or in the case of a cantilever, anywhere between the cantilever tip and the support. These values are for standard term load duration, and may be adjusted for other load durations as permitted by the code. The gap between the stiffener and the flange is at the bottom.


FIGURE 2
WEB STIFFENER INSTALLATION DETAILS

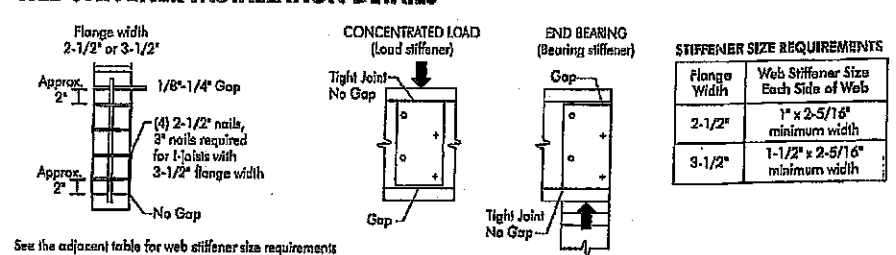

CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET

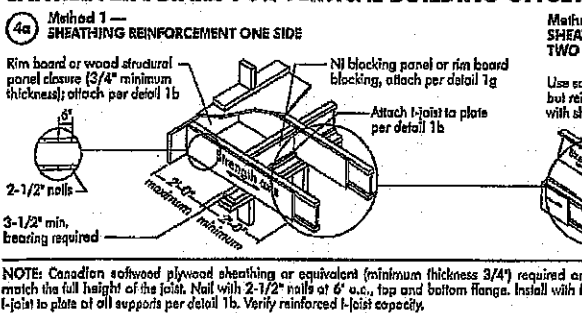

RIM BOARD INSTALLATION DETAILS

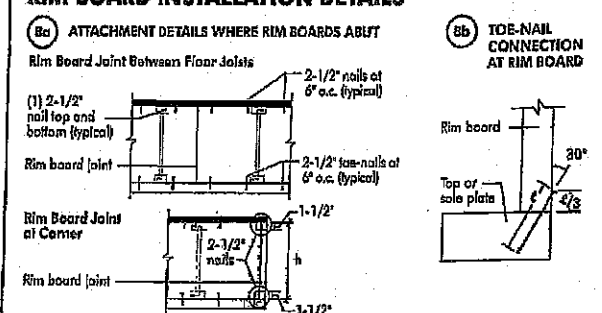

NORDIC STRUCTURES

COMPANY
Apr. 9, 2020 09:37


PROJECT
J1 1ST FLOOR.wwb

Design Check Calculation Sheet Nordic Sizer – Canada 7.2

Loads:

Load	Type	Distribution	Pat-tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

Maximum Reactions (lbs) and Support Bearing (in):

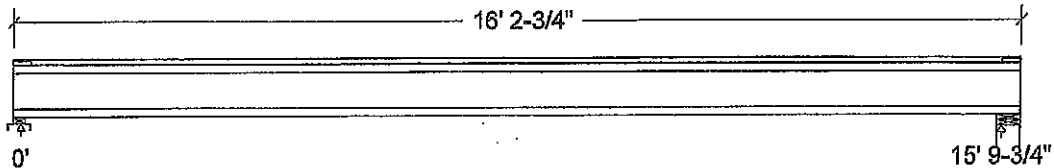

Unfactored:			
Dead	158		158
Live	316		316
Factored:			
Total	672		672
Bearing:			
Capacity			
Joist	1865		1893
Support	3971		7744
Des ratio			
Joist	0.36		0.36
Support	0.17		0.09
Load case	#2		#2
Length	2-3/8		4-3/8
Min req'd	1-3/4		1-3/4
Stiffener	No		No
KD	1.00		1.00
KB support	1.00		-
fcp sup	769		769
Kzcp sup	1.09		-


Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

Nordic 9-1/2" NI-40x Floor joist @ 12" o.c.

Supports: 1 - Lumber Sill plate, No.1/No.2; 2 - Lumber Wall, No.1/No.2;
Total length: 16' 2-3/4"; Clear span: 15' 8"; 3/4" nailed and glued OSB sheathing
This section PASSES the design code check.

Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 672	Vr = 1895	lbs	Vf/Vr = 0.35
Moment (+)	Mf = 2657	Mr = 4824	lbs-ft	Mf/Mr = 0.55
Perm. Defl'n	0.12 = < L/999	0.53 = L/360	in	0.22
Live Defl'n	0.24 = L/802	0.40 = L/480	in	0.60
Total Defl'n	0.35 = L/535	0.79 = L/240	in	0.45
Bare Defl'n	0.28 = L/672	0.53 = L/360	in	0.54
Vibration	Lmax = 15'-9.8	Lv = 17'-1.8	ft	0.92
Defl'n	= 0.032	= 0.041	in	0.77



NO. YAW5933 -20
STRUCTURAL
PERMANENT ONLY

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
EI	218.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L

Moment(+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth, groundwater E=earthquake

L=live(use, occupancy) Ls=live(storage, equipment) f=fire

Load Patterns: s=S/2 L=L+Ls _=no pattern load in this span

All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:E_{IEff} = 265.29 lb-in² K= 4.94e06 lbs

"Live" deflection is due to all non-dead loads (live, wind, snow...)

CONFORMS TO OBC 2012

AMENDED 2020

Design Notes:

1. WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4, and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to Nordic Structures technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



DWG NO. TAMS933 -20
STRUCTURAL
COMPONENT ONLY

**Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****1ST FLR FRAMING\Flush Beams\B1(i1903) (Flush Beam)**

Dry | 1 span | No cant.

February 10, 2020 08:08:13

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 3 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B1(i1903)

Specifier:

Designer:

Company:

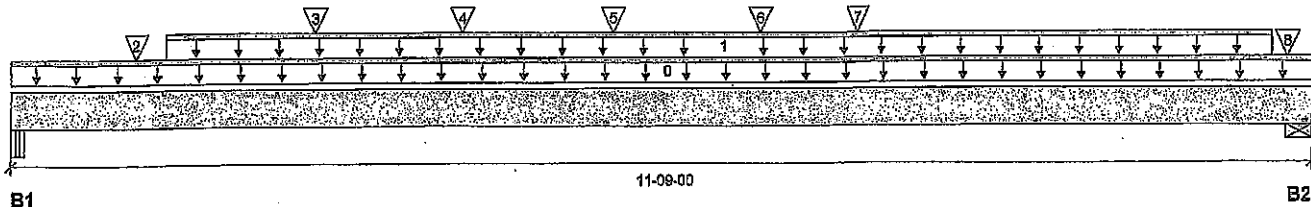

Total Horizontal Product Length = 11-09-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2-5/8"	2744 / 0	1460 / 0		
B2, 5-1/2"	4654 / 0	2658 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	11-09-00	Top	1.00	0.65	1.00	1.15	00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	01-04-10	11-04-10	Top	328	164			n/a
2	-	Conc. Pt. (lbs)	L	01-01-08	01-01-08	Top	597	298			n/a
3	J5(i1381)	Conc. Pt. (lbs)	L	02-08-08	02-08-08	Top	214	107			n/a
4	J5(i1568)	Conc. Pt. (lbs)	L	04-00-08	04-00-08	Top	567	284			n/a
5	J5(i1381)	Conc. Pt. (lbs)	L	05-04-08	05-04-08	Top	214	107			n/a
6	J5(i1434)	Conc. Pt. (lbs)	L	06-08-08	06-08-08	Top	180	90			n/a
7	B2(i1474)	Conc. Pt. (lbs)	L	07-07-02	07-07-02	Top	54				n/a
8	1(i599)	Conc. Pt. (lbs)	L	11-06-04	11-06-04	Top	2266	136			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	17040 ft-lbs	36222 ft-lbs	47.0%	1	05-04-08
End Shear	5820 lbs	17356 lbs	33.5%	1	01-00-02
Total Load Deflection	L/375 (0.358")	n/a	64.0%	4	05-07-09
Live Load Deflection	L/575 (0.234")	n/a	62.6%	5	05-07-09
Max Defl.	0.358"	n/a	n/a	4	05-07-09
Span / Depth	14.1				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 2-5/8" x 5-1/4"	5941 lbs	80.7%	35.3%	Unspecified
B2	Wall/Plate 5-1/2" x 5-1/4"	10303 lbs	58.0%	29.2%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.


Calculations assume unbraced length of Top: 00-00-00, Bottom: 00-00-00.

Resistance Factor phi has been applied to all presented results per CSA O86. **AMENDED 2020**


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9



PROVIDE 3 ROWS OF 3 1/2" ARDOX SPIRAL NAILS @ 12" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS



DWG NO. YAM 5941-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of Input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC Floor/Value®, VERSA-LAM®, VERSA-RIM PLUS®.



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

1ST FLR FRAMING\Flush Beams\B2(11474) (Flush Beam)

Dry | 1 span | No cant.

February 10, 2020 08:08:13

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 3 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B2(11474)

Specifier:

Designer:

Company:



B1

07-08-12

B2

Total Horizontal Product Length = 07-08-12

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2"	73 / 0	55 / 0		
B2, 3-1/2"	75 / 0	57 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	07-08-12	Top	1.00	0.65	1.00	1.15	
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	07-08-12	Top	19	10			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	320 ft-lbs	11610 ft-lbs	2.8%	1	03-09-10
End Shear	133 lbs	5785 lbs	2.3%	1	00-11-08
Total Load Deflection	L/999 (0.009")	n/a	n/a	4	03-09-10
Live Load Deflection	L/999 (0.005")	n/a	n/a	5	03-09-10
Max Defl.	0.009"	n/a	n/a	4	03-09-10
Span / Depth	9.3				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Hanger 2" x 1-3/4"	178 lbs	n/a	4.2%	HUS1.81/10
B2	Column 3-1/2" x 1-3/4"	184 lbs	3.7%	2.5%	Unspecified

Cautions

Header for the hanger HUS1.81/10 at B1 is a Triple 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF. Hanger model HUS1.81/10 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO UBC 2012

AMENDED 2020

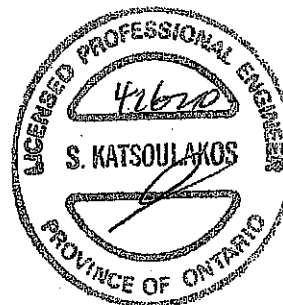

DWG NO. TAN 5942-20

STRUCTURAL

COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCJ®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

1ST FLR FRAMING\Flush Beams\B3(1810) (Flush Beam)

Dry | 1 span | No cant

February 10, 2020 08:08:13

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 3 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B3(1810)

Specifier:

Designer:

Company:

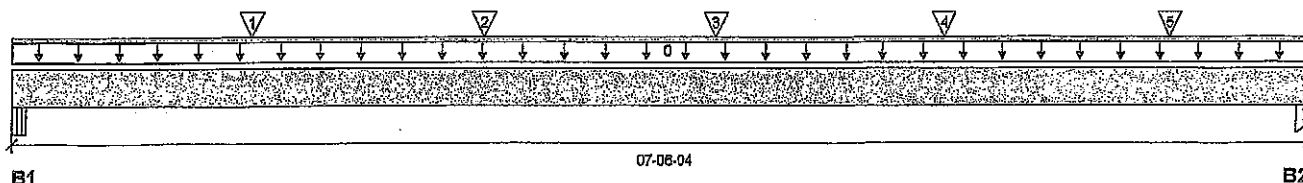

Total Horizontal Product Length = 07-06-04

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2-5/8"	610 / 0	324 / 0		
B2, 1-3/4"	614 / 0	325 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	07-06-04	Top	1.00	0.65	1.00	1.15	00-00-00
1	J5(1374)	Conc. Pt. (lbs)	L	01-04-08	01-04-08	Top	287	144			n/a
2	J5(1381)	Conc. Pt. (lbs)	L	02-08-08	02-08-08	Top	210	105			n/a
3	J5(1568)	Conc. Pt. (lbs)	L	04-00-08	04-00-08	Top	337	168			n/a
4	J5(1381)	Conc. Pt. (lbs)	L	05-04-08	05-04-08	Top	210	105			n/a
5	J5(1434)	Conc. Pt. (lbs)	L	06-08-08	06-08-08	Top	180	90			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	2854 ft-lbs	11610 ft-lbs	24.6%	1	04-00-08
End Shear	1313 lbs	5785 lbs	22.7%	1	01-00-02
Total Load Deflection	L/999 (0.074")	n/a	n/a	4	03-09-08
Live Load Deflection	L/999 (0.048")	n/a	n/a	5	03-09-08
Max Defl.	0.074"	n/a	n/a	4	03-09-08
Span / Depth	9.2				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 2-5/8" x 1-3/4"	1320 lbs	53.8%	23.5%	Unspecified
B2	Column 1-3/4" x 1-3/4"	1327 lbs	53.3%	35.5%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume unbraced length of Top: 00-00-00, Bottom: 00-00-00.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020

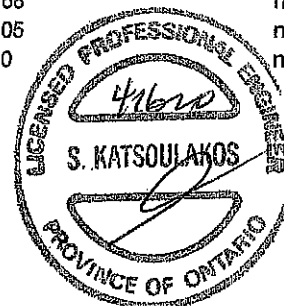

DWG NO. TAN 5943-20

STRUCTURAL

COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCi®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

**Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****1ST FLR FRAMING\Flush Beams\B4L(i41) (Flush Beam)**

Dry | 1 span | No cant.

February 10, 2020 08:08:13

BC CALC® Member Report
Build 7239

Job name:

File name: MOUNTAINASH 3 EL 1.mmdl

Address:

Description: 1ST FLR FRAMING\Flush Beams\B4L(i41)

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

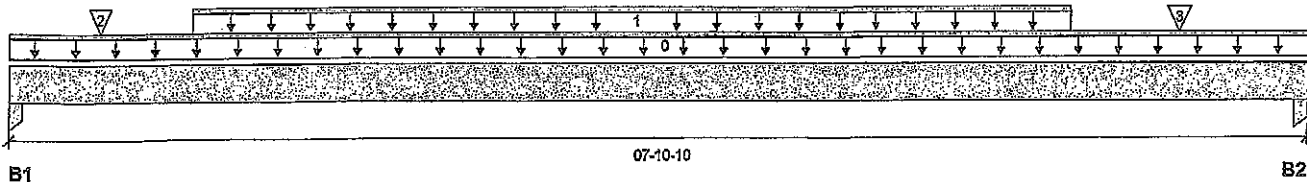

Total Horizontal Product Length = 07-10-10

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	773 / 0	405 / 0		
B2, 3-1/2"	775 / 0	406 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	07-10-10	Top	5				00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	01-01-04	06-05-04	Top	220	110			n/a
2	J3(i72)	Conc. Pt. (lbs)	L	00-06-08	00-06-08	Top	147	73			n/a
3	J3(i62)	Conc. Pt. (lbs)	L	07-01-04	07-01-04	Top	225	112			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	3234 ft-lbs	11610 ft-lbs	27.9%	1	04-05-04
End Shear	1482 lbs	5785 lbs	25.6%	1	06-09-10
Total Load Deflection	L/999 (0.09")	n/a	n/a	4	03-11-04
Live Load Deflection	L/999 (0.059")	n/a	n/a	5	03-11-04
Max Defl.	0.09"	n/a	n/a	4	03-11-04
Span / Depth	9.4				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Column 3-1/2" x 1-3/4"	1665 lbs	33.5%	22.3%	Unspecified
B2	Column 3-1/2" x 1-3/4"	1671 lbs	33.6%	22.4%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume unbraced length of Top: 00-05-04, Bottom: 00-05-04.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO CBC 2012**AMENDED 2020**

DWG NO. TAM 5944-20

STRUCTURAL**COMPONENT ONLY****Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA).

Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****1ST FLR FRAMING\Flush Beams\B5L(i450) (Flush Beam)**

Dry | 2 spans | No cant.

February 10, 2020 08:08:13

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 3 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B5L(i450)

Specifier:

Designer:

Company:

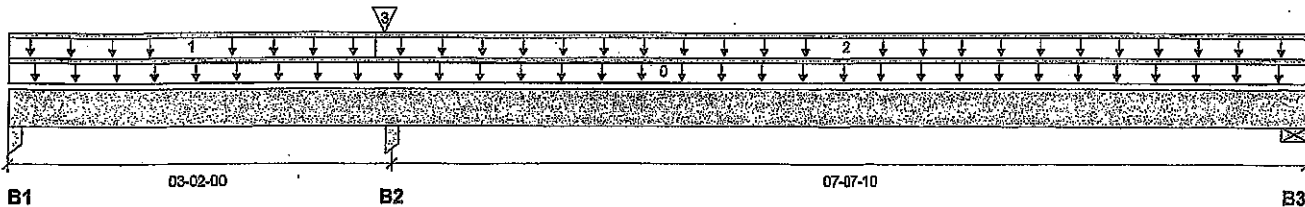

Total Horizontal Product Length = 10-09-10

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 1-3/4"	24 / 65	0 / 22		
B2, 3-1/2"	701 / 0	434 / 0		
B3, 1-7/8"	128 / 1	94 / 0		


Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	10-09-10	Top		10			00-00-00
1	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	03-00-04	Top	16	8			n/a
2	FC1 Floor Material	Unf. Lin. (lb/ft)	L	03-00-04	10-09-10	Top	40	20			n/a
3	B6L(i449)	Conc. Pt. (lbs)	L	03-01-02	03-01-02	Top	428	223			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	464 ft-lbs	23220 ft-lbs	2.0%	3	07-07-05
Neg. Moment	-505 ft-lbs	-23220 ft-lbs	2.2%	1	03-02-00
End Shear	216 lbs	11571 lbs	1.9%	1	09-10-04
Cont. Shear	342 lbs	11571 lbs	3.0%	1	04-01-04
Total Load Deflection	L/999 (0.006")	n/a	n/a	10	07-03-00
Live Load Deflection	L/999 (0.003")	n/a	n/a	13	07-03-00
Total Neg. Defl.	L/999 (-0.001")	n/a	n/a	10	01-10-14
Max Defl.	0.006"	n/a	n/a	10	07-03-00
Span / Depth	9.5				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Column	1-3/4" x 3-1/2"	16 lbs	0.3%	0.2%	Unspecified
B1 Uplift		126 lbs			
B2 Column	3-1/2" x 3-1/2"	1595 lbs	16.0%	10.7%	Unspecified
B3 Wall/Plate	1-7/8" x 3-1/2"	309 lbs	7.7%	3.9%	Spruce-Pine-Fir

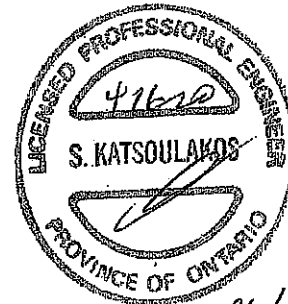CautionsUplift of 126 lbs found at bearing B1. *(SIMPSON 2-HZ-54 @ (7-91))*

BWG NO. TAM 5945-20
STRUCTURAL
COMPONENT ONLY



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

1ST FLR FRAMING\Flush Beams\B5L(i450) (Flush Beam)

Dry | 2 spans | No cant.

February 10, 2020 08:08:13

BC CALC® Member Report

Build 7239

Job name:

File name: MOUNTAINASH 3 EL 1.mmdl

Address:

Description: 1ST FLR FRAMING\Flush Beams\B5L(i450)

City, Province, Postal Code:

Specifier:

Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



PROVIDE 3 ROWS OF 3/8" ARBOX
SPIRAL NAILS @ 12" O/C FOR
MULTI-PLY NAILING. MAINTAIN
A MIN. 2" LUMBER EDGE/END
DISTANCE. DO NOT USE AIR NAILS



DWG NO. YAM 5945-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

1ST FLR FRAMING\Flush Beams\B6L(1449) (Flush Beam)

PASSED

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R

Dry | 1 span | No cant.

February 10, 2020 08:08:13


File name: MOUNTAINASH 3 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B6L(1449)

Specifier:

Designer:

Company:

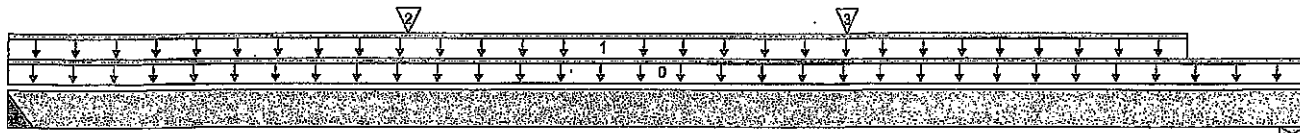

B1

03-11-14

B2

Total Horizontal Product Length = 03-11-14

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2"	440 / 0	229 / 0		
B2, 4-3/8"	416 / 0	219 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	03-11-14	Top		5			00-00-00
1	STAIR	Unf. Lin. (lb/ft)	L	00-00-00	03-07-08	Top	120	60			n/a
2	J5(i89)	Conc. Pt. (lbs)	L	01-02-10	01-02-10	Top	212	106			n/a
3	J5(i89)	Conc. Pt. (lbs)	L	02-06-10	02-06-10	Top	209	105			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	923 ft-lbs	11610 ft-lbs	7.9%	1	01-10-10
End Shear	696 lbs	5785 lbs	12.0%	1	00-11-08
Total Load Deflection	L/999 (0.006")	n/a	n/a	4	01-10-10
Live Load Deflection	L/999 (0.004")	n/a	n/a	5	01-10-10
Max Defl.	0.006"	n/a	n/a	4	01-10-10
Span / Depth	4.5				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Hanger 2" x 1-3/4"	946 lbs	n/a	22.2%	HUS1.81/10
B2	Wall/Plate 4-3/8" x 1-3/4"	898 lbs	19.1%	9.6%	Spruce-Pine-Fir

Cautions

Header for the hanger HUS1.81/10 at B1 is a Double 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF. Hanger model HUS1.81/10 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned


Resistance Factor phi has been applied to all presented results per CSA O86. AMENDED 2020

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

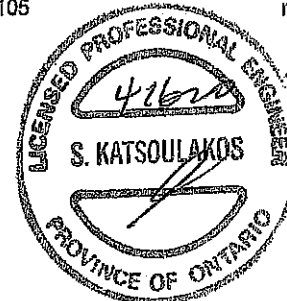

BWG NO. TAN 5946-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

1ST FLR FRAMING\Flush Beams\B1A\12350 (Flush Beam)


BC CALC® Member Report
Build 7239

Dry | 1 span | No cap.

April 15, 2020 16:25:10

Job name:
Address:
City, Province, Postal Code: WATERDOWN
Customer:
Code reports: CCMC 12472-R

File name: MOUNTAINASH 3 EL 1 DECK CONDITION.mmdl
Description: 1ST FLR FRAMING\Flush Beams\B1A\12350
Specifier:
Designer: AJ
Company:

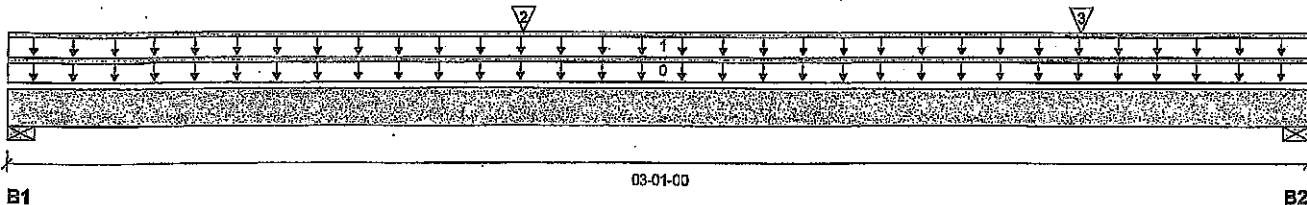

Total Horizontal Product Length = 03-01-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3"	770 / 0	525 / 0		
B2, 3"	968 / 0	624 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	03-01-00	Top		10			00-00-00
1	E13(i595)	Unf. Lin. (lb/ft)	L	00-00-00	03-01-00	Top	303	233			n/a
2	J2(i2020)	Conc. Pt. (lbs)	L	01-02-08	01-02-08	Top	402	201			n/a
3	J2(i2020)	Conc. Pt. (lbs)	L	02-06-08	02-06-08	Top	402	201			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1310 ft-lbs	23220 ft-lbs	5.6%	1	01-03-02
End Shear	1022 lbs	11571 lbs	8.8%	1	01-00-08
Total Load Deflection	L/999 (0.002")	n/a	n/a	4	01-06-04
Live Load Deflection	L/999 (0.001")	n/a	n/a	5	01-06-04
Max Defl.	0.002"	n/a	n/a	4	01-06-04
Span / Depth	3.4				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 3" x 3-1/2"	1812 lbs	28.0%	14.1%	Spruce-Pine-Fir
B2	Wall/Plate 3" x 3-1/2"	2233 lbs	34.6%	17.4%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86. AMENDED 2020

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012



PROVIDE 3 ROWS OF 3/2" ARDOX
SPIRAL NAILS @ 8" O/C FOR
MULTI-PLY NAILING. MAINTAIN
A MIN. 2" LUMBER EDGE/END
DISTANCE. DO NOT USE AIR NAILS



SWA NO. TAM 5950 -20
STRUCTURAL

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJST™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

NORDIC STRUCTURES

COMPANY
Apr. 9, 2020 09:37


PROJECT
J1 2ND FLOOR.wwb

Design Check Calculation Sheet Nordic Sizer – Canada 7.2

Loads:

Load	Type	Distribution	Pat-tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

Maximum Reactions (lbs) and Support Bearing (in):

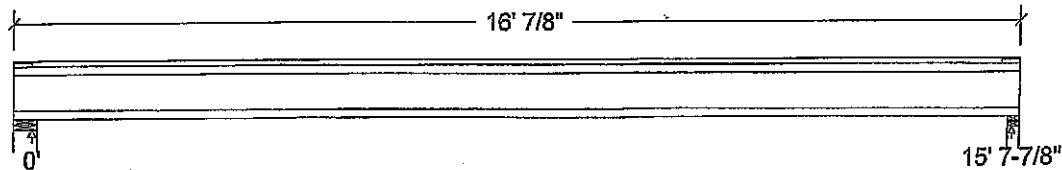

Unfactored:			
Dead	157		157
Live	313		313
Factored:			
Total	665		665
Bearing:			
Capacity			
Joist	1893		1865
Support	7744		3981
Des ratio			
Joist	0.35		0.36
Support	0.09		0.17
Load case	#2		#2
Length	4-3/8		2-3/8
Min req'd	1-3/4		1-3/4
Stiffener	No		No
KD	1.00		1.00
KB support	-		-
fcp sup	769		769
Kzcp sup	-		-

Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

Nordic 9-1/2" NI-40x Floor joist @ 12" o.c.

Supports: All - Lumber Wall, No.1/No.2

Total length: 16' 7/8"; Clear span: 15' 6-1/8"; 5/8" nailed and glued OSB sheathing with 1/2" gypsum ceiling

This section PASSES the design code check.

Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 665	Vr = 1895	lbs	Vf/Vr = 0.35
Moment (+)	Mf = 2604	Mr = 4824	lbs-ft	Mf/Mr = 0.54
Perm. Defl'n	0.12 = < L/999	0.52 = L/360	in	0.22
Live Defl'n	0.23 = L/805	0.39 = L/480	in	0.60
Total Defl'n	0.35 = L/537	0.78 = L/240	in	0.45
Bare Defl'n	0.27 = L/691	0.52 = L/360	in	0.52
Vibration	Lmax = 15'-7.9	Lv = 16'-8.5	ft	0.94
Defl'n	= 0.034	= 0.041	in	0.82



DWG NO. YAW 5934 -20
STRUCTURAL
COMPONENT ONLY

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
EI	218.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L
 Moment(+) : LC #2 = 1.25D + 1.5L
 Deflection: LC #1 = 1.0D (permanent)
 LC #2 = 1.0D + 1.0L (live)
 LC #2 = 1.0D + 1.0L (total)
 LC #2 = 1.0D + 1.0L (bare joist)
 Bearing : Support 1 - LC #2 = 1.25D + 1.5L
 Support 2 - LC #2 = 1.25D + 1.5L
 Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake
 L=live(use,occupancy) Ls=live(storage,equipment) f=fire
 Load Patterns: s=S/2 L=L+Ls _no pattern load in this span
 All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:


E_Ieff = 258.29 lb-in² K= 4.94e06 lbs
 "Live" deflection is due to all non-dead loads (live, wind, snow...)

CONFORMS TO OBC 2012

AMENDED 2020

Design Notes:

1. WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4, and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to Nordic Structures technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.

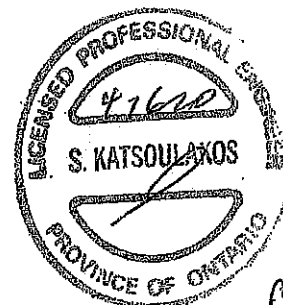

DWG NO. TAM 5934-20
 STRUCTURAL
 COMPONENT ONLY



Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLR FRAMING\Dropped Beams\B8 DR\1852 (Dropped Beam)

BC CALC® Member Report

Dry | 1 span | No cant.

February 10, 2020 08:08:13

Build 7239

Job name:

File name: MOUNTAINASH 3 EL 1.mmdl

Address:

Description: 2ND FLR FRAMING\Dropped Beams\B8 DR\1852

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

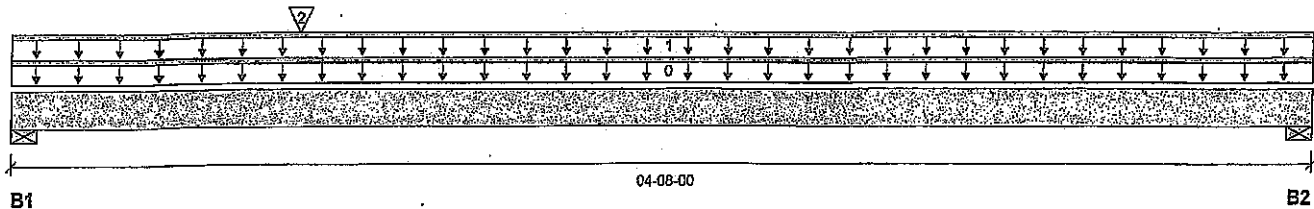

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 4"	2950 / 0	1585 / 0		
B2, 4"	1262 / 0	682 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	04-08-00	Top	14				00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-00-00	04-08-00	Top	330	165			n/a
2	B10(1818)	Conc. Pl. (lbs)	L	01-00-04	01-00-04	Top	2669	1428			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	4176 ft-lbs	36222 ft-lbs	11.5%	1	01-00-04
End Shear	4794 lbs	17356 lbs	27.6%	1	01-01-08
Total Load Deflection	L/999 (0.011")	n/a	n/a	4	02-02-00
Live Load Deflection	L/999 (0.007")	n/a	n/a	5	02-02-00
Max Defl.	0.011"	n/a	n/a	4	02-02-00
Span / Depth	5.2				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 4" x 5-1/4"	6406 lbs	22.9%	25.0%	Spruce-Pine-Fir
B2	Wall/Plate 4" x 5-1/4"	2745 lbs	9.8%	10.7%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.


Calculations assume unbraced length of Top: 00-03-09, Bottom: 00-03-09.

Resistance Factor phi has been applied to all presented results per CSA O86. **AMENDED 2020**

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

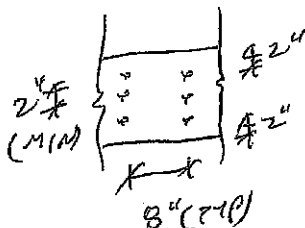

PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 8" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS. STAGGER NAILS 4" BETWEEN PLIES.



OWN NO. TAM 5935-20

STRUCTURAL

COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B10(i1818) (Flush Beam)**

BC CALC® Member Report

Dry | 1 span | No cant

February 10, 2020 08:08:13

Build 7239

Job name:

File name: MOUNTAINASH 3 EL 1.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B10(i1818)

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

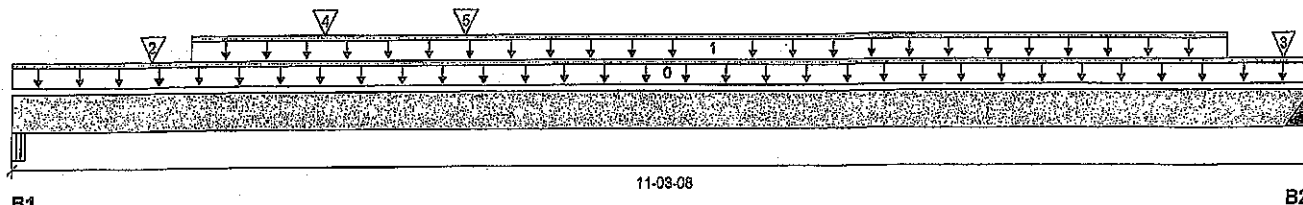

Total Horizontal Product Length = 11-03-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2-1/2"	2633 / 0	1409 / 0		
B2, 4"	2057 / 0	1105 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	11-03-08	Top		10			00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	01-06-08	10-06-08	Top	315	158			n/a
2	-	Conc. Pt. (lbs)	L	01-02-08	01-02-08	Top	967	483			n/a
3	J1(i1626)	Conc. Pt. (lbs)	L	11-00-08	11-00-08	Top	232	116			n/a
4	J2(i1788)	Conc. Pt. (lbs)	L	02-08-06	02-08-06	Top	323	162			n/a
5	B11(i1835)	Conc. Pt. (lbs)	L	03-10-12	03-10-12	Top	308	212			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	13379 ft-lbs	23220 ft-lbs	57.6%	1	05-00-08
End Shear	5679 lbs	11571 lbs	49.1%	1	01-00-00
Total Load Deflection	L/324 (0.403")	n/a	74.1%	4	05-06-08
Live Load Deflection	L/499 (0.261")	n/a	72.1%	5	05-06-08
Max Defl.	0.403"	n/a	n/a	4	05-06-08
Span / Depth	13.7				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 2-1/2" x 3-1/2"	5712 lbs	53.5%	53.5%	VL 2.0 3100 SP
B2	Hanger 4" x 3-1/2"	4467 lbs	n/a	26.2%	HGUS410

Cautions

Header for the hanger HGUS410 at B2 is a Triple 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF. Hanger model HGUS410 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.


Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86. AMENDED 2020

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.


Importance Factor : Normal Part code : Part 9



PROVIDES ROWS OF 3/4" ARDOX SPIRAL NAILS @ 12" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS

CONFORMS TO DBC 2012

AMENDED 2020

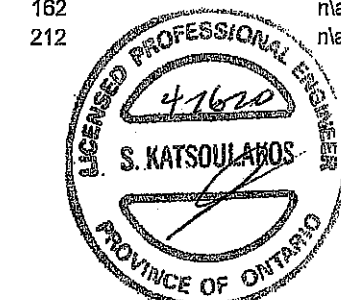

SWK NO. YAM 5936-20

STRUCTURAL

COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AIS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****2ND FLR FRAMING\Flush Beams\B11(i1835) (Flush Beam)****PASSED**

BC CALC® Member Report

Dry | 1 span | No cant.

February 10, 2020 08:08:13

Build 7239

Job name:

File name: MOUNTAINASH 3 EL 1.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B11(i1835)

City, Province, Postal Code:

Specifier:



Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

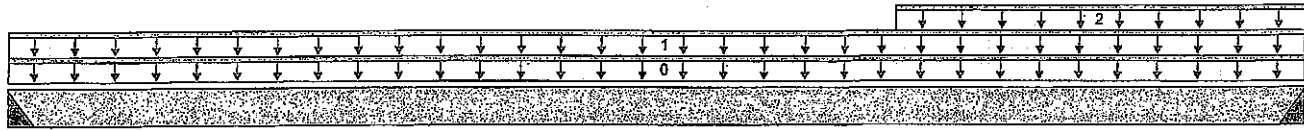

Total Horizontal Product Length = 11-11-04

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 4"	294 / 0	204 / 0		
B2, 4"	947 / 0	531 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	11-11-04	Top	1.00	10			00-00-00
1	FC3 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	11-11-04	Top	27	13			n/a
2	STAIR	Unf. Lin. (lb/ft)	L	08-01-04	11-11-04	Top	240	120			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	3203 ft-lbs	23220 ft-lbs	13.8%	1	08-03-05
End Shear	1432 lbs	11571 lbs	12.4%	1	10-09-12
Total Load Deflection	L/999 (0.098")	n/a	n/a	4	06-04-05
Live Load Deflection	L/999 (0.061")	n/a	n/a	5	06-05-10
Max Defl.	0.098"	n/a	n/a	4	06-04-05
Span / Depth	14.4				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Hanger	4" x 3-1/2"	696 lbs	n/a	4.1%	HGUS410
B2 Hanger	4" x 3-1/2"	2083 lbs	n/a	12.2%	HGUS410

Cautions


Header for the hanger HGUS410 at B1 is a Double 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF.
 Hanger model HGUS410 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.
 Header for the hanger HGUS410 at B2 is a Double 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Calculations assume member is fully braced.
 Hanger Manufacturer: Unassigned
 Resistance Factor phi has been applied to all presented results per CSA O86.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

PROVIDE 3 ROWS OF 3x" ARDOX SPIRAL NAILS @ 12" O/C FOR MULTI-PLY NAILING, MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS



NO. 5937-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B12\1923) (Flush Beam)**

Dry | 1 span | No cant.

February 10, 2020 08:08:13

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 3 EL 1.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B12\1923)

Specifier:

Designer:

Company:

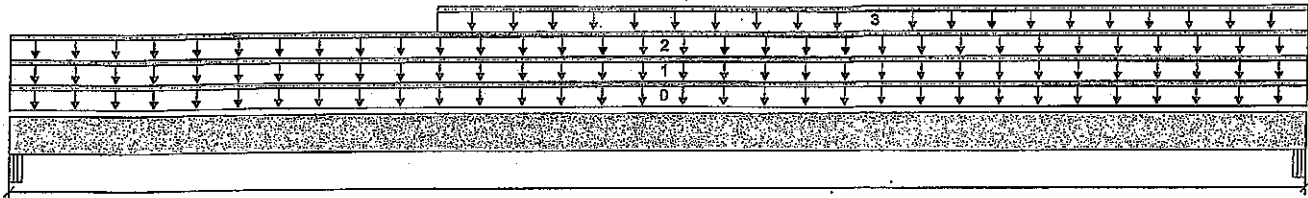

B1

B2

Total Horizontal Product Length = 01-04-02

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/4"	30 / 0	32 / 0	45 / 0	
B2, 4-1/8"	28 / 0	29 / 0	39 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	01-04-02	Top		10			00-00-00
1	ROOF	Unf. Lin. (lb/ft)	L	00-00-00	01-04-02	Top	33	30	63		n/a
2	FC3 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	01-04-02	Top	6	3			n/a
3	FC3 Floor Material	Unf. Lin. (lb/ft)	L	00-05-04	01-04-02	Top	6	3			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/ Resistance	Case	Location
Pos. Moment	12 ft-lbs	23220 ft-lbs	n/a	13	00-08-10
End Shear	55 lbs	11571 lbs	0.5%	13	00-05-04
Span / Depth	0.9				

Bearing Supports	Dim. (LxW)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material
B1 Beam	5-1/4" x 3-1/2"	137 lbs	1.4%	0.6%	Unspecified
B2 Beam	4-1/8" x 3-1/2"	123 lbs	1.6%	0.7%	Unspecified

Notes

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.


Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.


Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

AMENDED 2020



PROVIDE 3 ROWS OF 3/4" ARBOX
SPIRAL NAILS @ 6" O/C FOR
MULTI-PLY NAILING. MAINTAIN
A MIN. 2" LUMBER EDGE/END
DISTANCE. DO NOT USE AIR NAILS

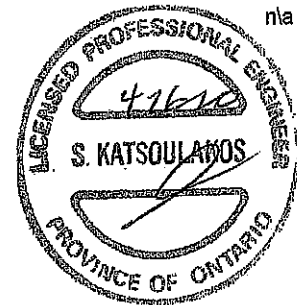

DWG NO. YAIN 5938-20
STRUCTURAL

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B7(1816) (Flush Beam)**

BC CALC® Member Report

Dry | 1 span | No cant.

February 10, 2020 08:08:12

Build 7239

Job name:

File name: MOUNTAINASH 3 EL 1.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B7(1816)

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

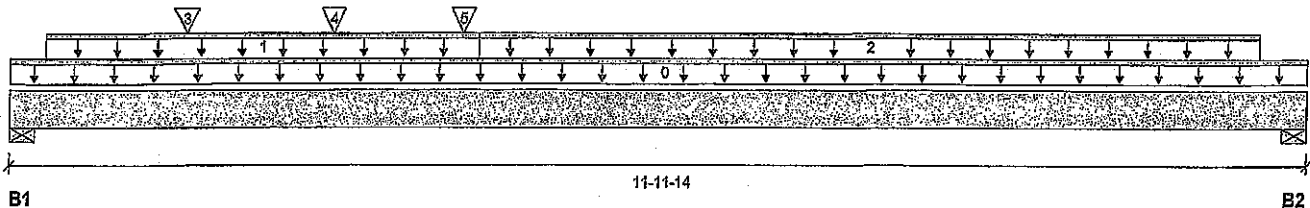

Total Horizontal Product Length = 11-11-14

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/2"	1431 / 0	811 / 0		
B2, 5-1/2"	563 / 0	359 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	11-11-14	Top		10			00-00-00
1	FC3 Floor Material	Unf. Lin. (lb/ft)	L	00-04-00	04-03-08	Top	19	9			n/a
2	FC3 Floor Material	Unf. Lin. (lb/ft)	L	04-03-08	11-06-06	Top	21	11			n/a
3	J2(1743)	Conc. Pt. (lbs)	L	01-07-06	01-07-06	Top	497	248			n/a
4	J2(1788)	Conc. Pt. (lbs)	L	02-11-06	02-11-06	Top	323	162			n/a
5	B11(1835)	Conc. Pt. (lbs)	L	04-01-12	04-01-12	Top	933	524			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/ Resistance	Case	Location
Pos. Moment	7954 ft-lbs	23220 ft-lbs	34.3%	1	04-01-12
End Shear	3108 lbs	11571 lbs	26.9%	1	01-03-00
Total Load Deflection	L/631 (0.213")	n/a	38.0%	4	05-06-00
Live Load Deflection	L/1003 (0.134")	n/a	35.9%	5	05-06-00
Max Defl.	0.213"	n/a	n/a	4	05-06-00
Span / Depth	14.1				

Bearing Supports

	Dim. (LxW)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material
B1	Wall/Plate 5-1/2" x 3-1/2"	3161 lbs	26.7%	13.5%	Spruce-Pine-Fir
B2	Wall/Plate 5-1/2" x 3-1/2"	1293 lbs	10.9%	5.5%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.


Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



PROVIDE 3 ROWS OF 3/4" ARBOX
SPIRAL NAILS @ 12" O/C FOR
MULTI-PLY NAILING. MAINTAIN
A MIN. 2" LUMBER EDGE/END
DISTANCE. DO NOT USE AIR NAILS

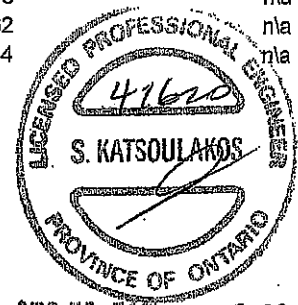

DWG NO. YAM 5939-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Boise Cascade



Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLR FRAMING\Flush Beams\B9(1804) (Flush Beam)

Dry | 1 span | No cant.

February 10, 2020 08:08:13

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 3 EL 1.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B9(1804)

Specifier:

Designer:

Company:

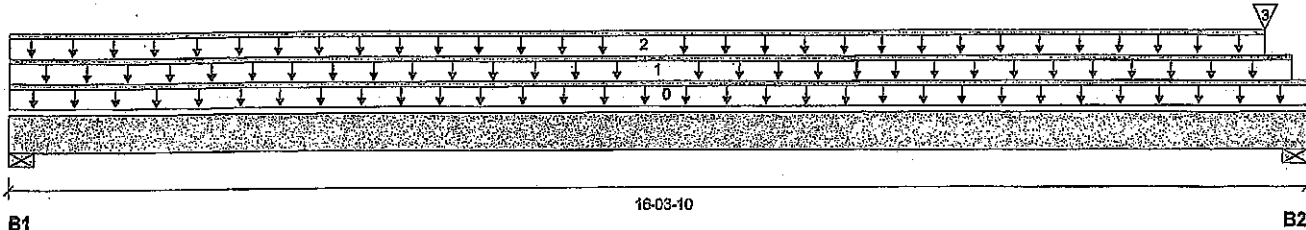

Total Horizontal Product Length = 16-03-10

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 4-3/8"	250 / 0	242 / 0		
B2, 5-1/4"	2264 / 0	1327 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	16-03-10	Top	1.00	0.65	1.00	1.15	00-00-00
1	FC3 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	16-00-14	Top	21	11			n/a
2	FC3 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	15-08-10	Top	9	5			n/a
3	B10(i1818)	Conc. Pt. (lbs)	L	15-08-10	15-08-10	Top	2021	1087			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	2550 ft-lbs	36222 ft-lbs	7.0%	1	08-01-06
End Shear	594 lbs	17356 lbs	3.4%	1	15-00-14
Total Load Deflection	L/999 (0.108")	n/a	n/a	4	08-01-06
Live Load Deflection	L/999 (0.055")	n/a	n/a	5	08-01-06
Max Defl.	0.108"	n/a	n/a	4	08-01-06
Span / Depth	19.7				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 4-3/8" x 5-1/4"	678 lbs	4.8%	2.4%	Spruce-Pine-Fir
B2	Wall/Plate 5-1/4" x 5-1/4"	5055 lbs	29.8%	15.0%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



PROVIDE 3 ROWS OF 3/4" ARDOX
SPIRAL NAILS @ 12" O/C FOR
MULTI-PLY NAILING. MAINTAIN
A MIN. 2" LUMBER EDGE/END
DISTANCE. DO NOT USE AIR NAILS
STAGGER NAILS 6" BETWEEN PLYS



DWG NO. TAM 5940-20

STRUCTURAL

COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP 2ND FLR FRAMING\Flush Beams\B14(i2116) (Flush Beam)

PASSED

BC CALC® Member Report

Dry | 1 span | No cant.

December 3, 2020 11:24:39

Build 7493

Job name:

File name: MOUNTAINASH 3 EL 1.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B14(i2116)

City, Province, Postal Code: WATERDOWN

Specifier:


Customer:

Designer: AJ

Code reports:

CCMC 12472-R

Company:

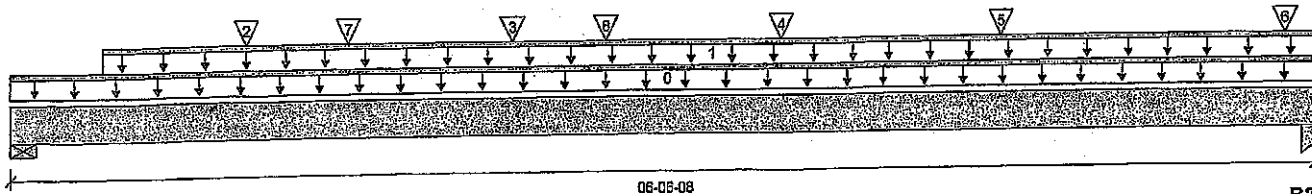

Total Horizontal Product Length = 06-06-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/2"	647 / 0	739 / 0	439 / 0	
B2, 3-7/16"	592 / 0	1075 / 0	191 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	06-06-08	Top		10			00-00-00
1	WALL	Unf. Lin. (lb/ft)	L	00-05-08	06-06-08	Top		100			n/a
2	J5(i2259)	Conc. Pt. (lbs)	L	01-02-00	01-02-00	Top	181	90			n/a
3	J5(i2257)	Conc. Pt. (lbs)	L	02-06-00	02-06-00	Top	205	103			n/a
4	J5(i2258)	Conc. Pt. (lbs)	L	03-10-00	03-10-00	Top	190	95			n/a
5	J5(i2261)	Conc. Pt. (lbs)	L	04-11-10	04-11-10	Top	209	104			n/a
6	B15(i2117)	Conc. Pt. (lbs)	L	06-04-12	06-04-12	Top	124	451			n/a
7	GIRDER	Conc. Pt. (lbs)	L	01-08-04	01-08-04	Top	198	180	378		n/a
8	GIRDER	Conc. Pt. (lbs)	L	02-11-08	02-11-08	Top	132	120	252		n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	3502 ft-lbs	23220 ft-lbs	15.1%	1	02-11-07
End Shear	2178 lbs	11571 lbs	18.8%	1	01-03-00
Total Load Deflection	L/999 (0.033")	n/a	n/a	35	03-02-12
Live Load Deflection	L/999 (0.019")	n/a	n/a	51	03-02-12
Max Defl.	0.033"	n/a	n/a	35	03-02-12
Span / Depth	7.5				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 5-1/2" x 3-1/2"	2332 lbs	19.7%	9.9%	Spruce-Pine-Fir
B2	Column 3-7/16" x 3-1/2"	2424 lbs	24.7%	16.4%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



ENG NO. TAM 16920-20
STRUCTURAL
COMPONENT ONLY



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP
2ND FLR FRAMING\Flush Beams\B14(I2116) (Flush Beam)

PASSED

BC CALC® Member Report

Dry | 1 span | No cant.

December 3, 2020 11:24:39

Build 7493

Job name:

File name: MOUNTAINASH 3 EL 1.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B14(I2116)

City, Province, Postal Code: WATERDOWN

Specifier:


Customer:

Designer: AJ

Code reports: CCMC 12472-R

Company:

Connection Diagram: Full Length of Member

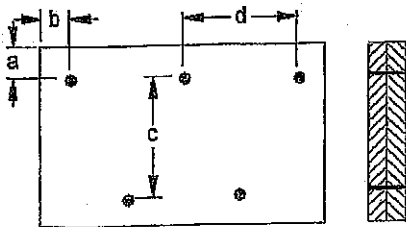

a minimum = 2"

c = 5-1/2"

b minimum = 3"

d = 12" @ 4"

Calculated Side Load = 315.7 lb/ft

Connectors are: Nails

3/4" ARDOX SPIRAL



DWG NO. TAM 1692-20

STRUCTURAL

COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJST™, ALLJOIST®, BC RIM BOARD™, BCi®, BOISE GLULAM™, BC Floor/Value®, VERSA-LAM®, VERSA-RIM PLUS®

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B15(i2117) (Flush Beam)**

Dry | 1 span | No cant.

December 3, 2020 11:24:39

BC CALC® Member Report

Build 7493

Job name:

Address:

City, Province, Postal Code: WATERDOWN

Customer:

Code reports: CCMC 12472-R


File name: MOUNTAINASH 3 EL 1.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B15(i2117)

Specifier:

Designer: AJ

Company:

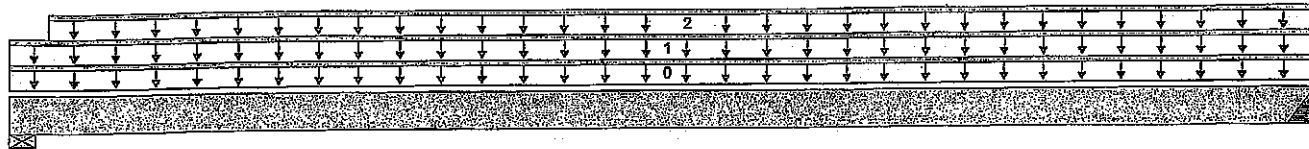

B1

07-06-00

B2

Total Horizontal Product Length = 07-06-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/2"	115 / 0	485 / 0		
B2, 2"	113 / 0	452 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	07-06-00	Top		10			00-00-00
1	WALL	Unf. Lin. (lb/ft)	L	00-00-00	07-06-00	Top		100			n/a
2	FC3 Floor Material	Unf. Lin. (lb/ft)	L	00-02-12	07-06-00	Top	31	16			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1075 ft-lbs	15093 ft-lbs	7.1%	0	03-10-12
End Shear	464 lbs	7521 lbs	6.2%	0	01-03-00
Total Load Deflection	L/999 (0.017")	n/a	n/a	4	03-10-12
Live Load Deflection	L/999 (0.003")	n/a	n/a	5	03-10-12
Max Defl.	0.017"	n/a	n/a	4	03-10-12
Span / Depth	8.8				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 5-1/2" x 3-1/2"	679 lbs	8.8%	4.4%	Spruce-Pine-Fir
B2	Hanger 2" x 3-1/2"	633 lbs	n/a	11.4%	HUC410

Cautions

Header for the hanger HUC410 is a Double 1-3/4" x 9-1/2" LVL Beam.

Hanger model HUC410 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

AMENDED 2020



OWN NO. YAM 16921-20
STRUCTURAL
COMPONENT ONLY



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP
2ND FLR FRAMING\Flush Beams\B15(i2117) (Flush Beam)

PASSED

BC CALC® Member Report

Dry | 1 span | No cant.

December 3, 2020 11:24:39

Build 7493

Job name:

Address:

City, Province, Postal Code: WATERDOWN

Customer:

Code reports: CCMC 12472-R

File name: MOUNTAINASH 3 EL.1.mmdl


Description: 2ND FLR FRAMING\Flush Beams\B15(i2117)

Specifier:

Designer: AJ

Company:

Connection Diagram: Full Length of Member

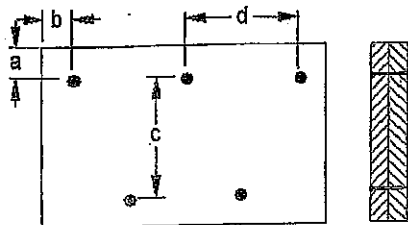

a minimum = 2"


b minimum = 3"

c = 5-1/2"

d = 6"

Connectors are: 3/4" ARDOX SPIRAL Nails

3/4" ARDOX SPIRAL

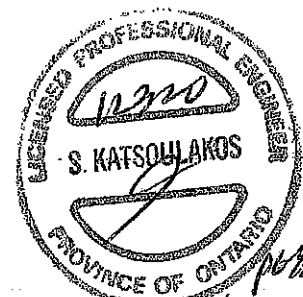

OWN NO. TAM 1694-20
STRUCTURAL

Disclosure COMPONENT ONLY

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLR FRAMING\Flush Beams\B12B(i2082)(Flush Beam)

Dry | 1 span | No cant.

December 3, 2020 11:21:49

BC CALC® Member Report

Build 7493

Job name:

Address:

City, Province, Postal Code: WATERDOWN

Customer:

Code reports: CCMC 12472-R


File name: MOUNTAINASH 3 EL 2.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B12B(i2082)

Specifier:

Designer: AJ

Company:

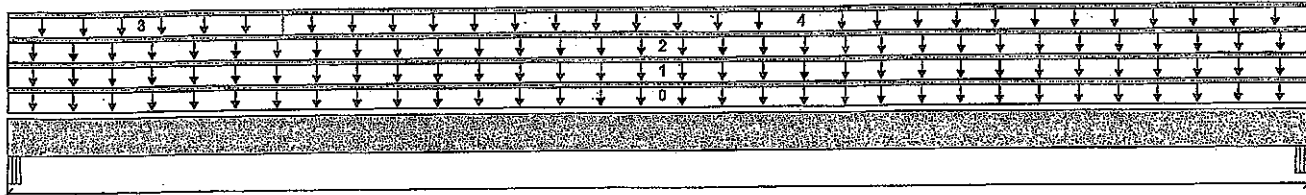

B1

02-01-02

B2

Total Horizontal Product Length = 02-01-02

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/4"	66 / 0	58 / 0	69 / 0	
B2, 4-1/8"	61 / 0	54 / 0	63 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	02-01-02	Top		10			00-00-00
1	ROOF	Unf. Lin. (lb/ft)	L	00-00-00	02-01-02	Top	33	30	63		n/a
2	FC3 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	02-01-02	Top	22	11			n/a
3	FC3 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	00-05-04	Top	5	3			n/a
4	FC3 Floor Material	Unf. Lin. (lb/ft)	L	00-05-04	02-01-02	Top	6	3			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/ Resistance	Case	Location
Pos. Moment	57 ft-lbs	23220 ft-lbs	0.2%	13	01-01-02
End Shear	30 lbs	11571 lbs	0.3%	1	01-02-12
Span / Depth	1.8				

Bearing Supports

	Dim. (LxW)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material
B1 Beam	5-1/4" x 3-1/2"	243 lbs	2.5%	1.1%	Unspecified
B2 Beam	4-1/8" x 3-1/2"	222 lbs	2.9%	1.3%	Unspecified

Notes

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.


Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor ; Normal Part code : Part 9

CONFORMS TO ORC 2012

AMENDED 2020

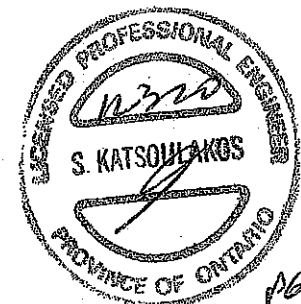

DWG NO. YAM/1692-20
STRUCTURAL
COMPONENT ONLY



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B12B(i2082) (Flush Beam)**

Dry | 1 span | No cant.

December 3, 2020 11:21:49

BC CALC® Member Report

Build 7493

Job name:

Address:

City, Province, Postal Code: WATERDOWN

Customer:

Code reports: CCMC 12472-R


File name: MOUNTAINASH 3 EL 2.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B12B(i2082)

Specifier:

Designer: AJ

Company:

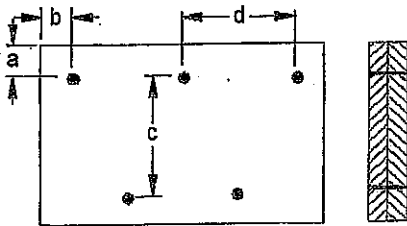Connection Diagram: Full Length of Member

a minimum = 2"

b minimum = 3"

c = 5-1/2"

d = 0"

Connectors are: 1/2" ARDOX SPIRAL Nails



DWG NO. FAN 1692-20

STRUCTURAL

COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B15B(i2073) (Flush Beam)**

Dry | 1 span | No cant.

December 3, 2020 11:23:34

BC CALC® Member Report

Build 7493

Job name:

Address:

City, Province, Postal Code: WATERDOWN

Customer:

Code reports: CCMC 12472-R


File name: MOUNTAINASH 3 EL 2.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B15B(i2073)

Specifier:

Designer: AJ

Company:

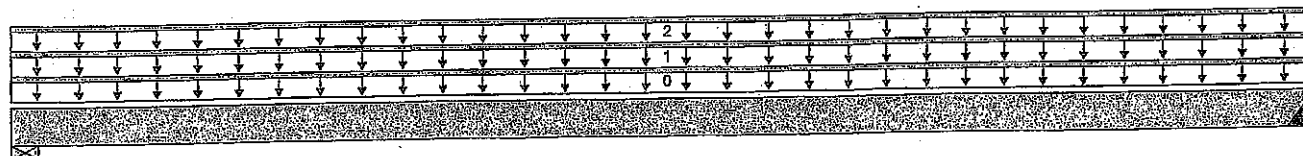

B1

07-03-08

B2

Total Horizontal Product Length = 07-03-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3"	383 / 0	587 / 0		
B2, 4"	392 / 0	600 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	07-03-08	Top		10			00-00-00
1	FC3 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	07-03-08	Top	106	53			n/a
2	WALL	Unf. Lin. (lb/ft)	L	00-00-00	07-03-08	Top		100			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	2118 ft-lbs	23220 ft-lbs	9.1%	1	03-07-04
End Shear	930 lbs	11571 lbs	8.0%	1	01-00-08
Total Load Deflection	L/999 (0.026")	n/a	n/a	4	03-07-04
Live Load Deflection	L/999 (0.01")	n/a	n/a	5	03-07-04
Max Defl.	0.026"	n/a	n/a	4	03-07-04
Span / Depth	8.6				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 3" x 3-1/2"	1307 lbs	20.2%	10.2%	Spruce-Pine-Fir
B2	Hanger 4" x 3-1/2"	1338 lbs	n/a	7.8%	HGUS410

Cautions

Hanger model HGUS410 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO ORG 2012

AMENDED 2020



DWG NO. YAH 16923-20
STRUCTURAL
COMPONENT ONLY



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP
2ND FLR FRAMING\Flush Beams\B15B(i2073) (Flush Beam)

PASSED

BC CALC® Member Report

Dry | 1 span | No cant.

December 3, 2020 11:23:34

Build 7493

Job name:

File name: MOUNTAINASH 3 EL 2.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B15B(i2073)

City, Province, Postal Code: WATERDOWN

Specifier:


Customer:

Designer: AJ

Code reports: CCMC 12472-R

Company:


Connection Diagram: Full Length of Member

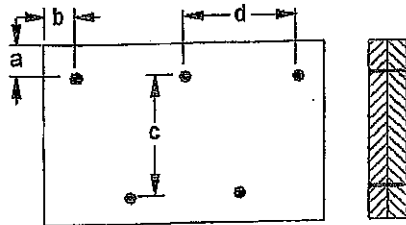

a minimum = 2"
b minimum = 3"

c = 5-1/2"
d = 6"

Connectors are: 3/4" ARDOX SPIRAL

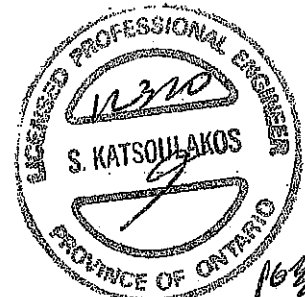

ENG NO. TAM 16923-20

STRUCTURAL

COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP 2ND FLR FRAMING\Flush Beams\B16(i2399) (Flush Beam)

PASSED

BC CALC® Member Report

Dry | 1 span | No cant.

February 10, 2020 08:45:04

Build 7239

Job name:

File name: MOUNTAINASH 3 EL 2.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B16(i2399)

City, Province, Postal Code: WATERDOWN


Specifier:

Customer:

Designer: AJ

Code reports: CCMC 12472-R

Company:

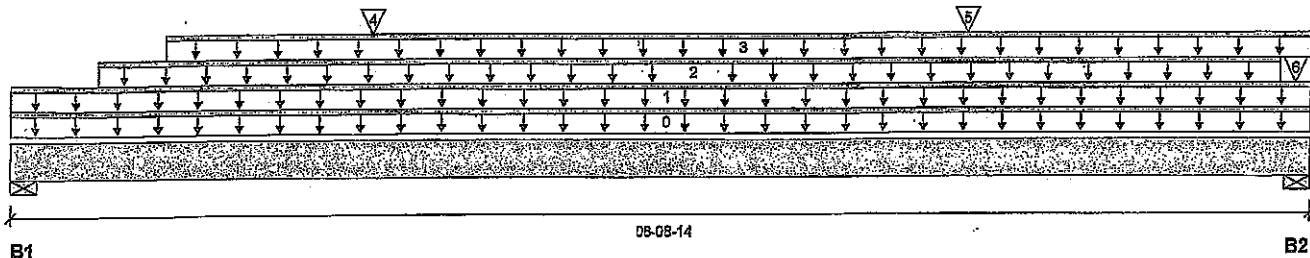

Total Horizontal Product Length = 08-08-14

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 12-3/8"	270 / 0	576 / 0	92 / 0	
B2, 2-1/2"	254 / 0	577 / 0	76 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	08-08-14	Top		10			00-00-00
1	FC3 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	08-08-14	Top	5	3			n/a
2	FC3 Floor Material	Unf. Lin. (lb/ft)	L	00-06-14	08-06-06	Top	46	23			n/a
3	WALL	Unf. Lin. (lb/ft)	L	01-00-06	08-08-14	Top		100			n/a
4	WINDOW	Conc. Pt. (lbs)	L	02-04-14	02-04-14	Top	44	40			n/a
5	WINDOW	Conc. Pt. (lbs)	L	06-04-14	06-04-14	Top	44	40			n/a
6	FC3 Floor Material	Conc. Pt. (lbs)	L	08-07-10	08-07-10	Top	21				n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1478 ft-lbs	15093 ft-lbs	9.8%	0	04-09-06
End Shear	622 lbs	7521 lbs	8.3%	0	01-09-14
Total Load Deflection	L/999 (0.035")	n/a	n/a	35	04-09-06
Live Load Deflection	L/999 (0.013")	n/a	n/a	51	04-09-06
Max Defl.	0.035"	n/a	n/a	35	04-09-06
Span / Depth	9.6				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 12-3/8" x 3-1/2"	807 lbs	4.7%	2.3%	Spruce-Pine-Fir
B2	Wall/Plate 2-1/2" x 3-1/2"	808 lbs	23.1%	11.6%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.


Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected products verification.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9



CONFORMS TO OBC 2012

AMENDED 2020

PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 12" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCIO®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

SWG NO. TAM5947-20
STRUCTURAL



Boise Cascade



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLR FRAMING\Flush Beams\B14C DR(i2413) (Flush Beam)

BC CALC® Member Report

Dry | 1 span | No cant.

February 10, 2020 09:01:54

Build 7239

Job name:

File name: MOUNTAINASH 3 EL 3.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B14C DR(i2413)

City, Province, Postal Code: WATERDOWN

Specifier:


Customer:

Designer: AJ

Code reports:

CCMC 12472-R

Company:

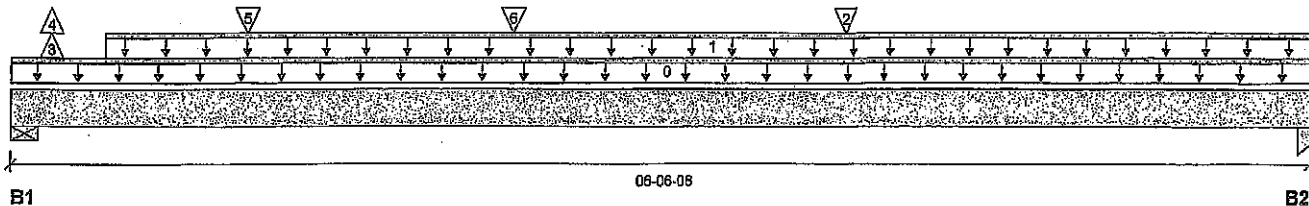

Total Horizontal Product Length = 06-06-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/2"	423 / 80	578 / 0	28 / 0	
B2, 3-7/16"	236 / 0	734 / 0	52 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	06-06-08	Top	10				00-00-00
1	WALL	Unf. Lin. (lb/ft)	L	00-05-08	06-06-08	Top	100				n/a
2	-	Conc. Pt. (lbs)	L	04-01-14	04-01-14	Top	229	521	80		n/a
3	J5(i2419)	Conc. Pt. (lbs)	L	00-02-06	00-02-06	Top	48	-72			n/a
4	J5(i2419)	Conc. Pt. (lbs)	L	00-02-06	00-02-06	Top	-80				n/a
5	J4(i2436)	Conc. Pt. (lbs)	L	01-02-00	01-02-00	Top	176	88			n/a
6	J4(i2371)	Conc. Pt. (lbs)	L	02-06-00	02-06-00	Top	203	102			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1717 ft-lbs	15093 ft-lbs	11.4%	0	03-11-05
End Shear	861 lbs	7521 lbs	11.5%	0	05-05-09
Total Load Deflection	L/999 (0.023")	n/a	n/a	58	03-05-00
Live Load Deflection	L/999 (0.008")	n/a	n/a	85	03-04-00
Max Defl.	0.023"	n/a	n/a	58	03-05-00
Span / Depth	7.5				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 5-1/2" x 3-1/2"	1385 lbs	5.4%	5.9%	Spruce-Pine-Fir
B2	Column 3-7/16" x 3-1/2"	1027 lbs	16.1%	10.7%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume unbraced length of Top: 02-01-08, Bottom: 02-01-08.

Resistance Factor phi has been applied to all presented results per CSA O86. AMENDED 2020

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.


Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 8" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS

2" #2 (41M) 8" (21P)

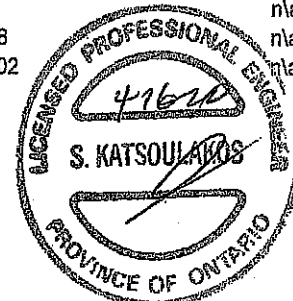

DWC NO. TAW 5949 -20

STRUCTURAL

DISCLOSURE

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Dropped Beams\B15C DR(i2381) (Dropped Beam)**

BC CALC® Member Report

Dry | 1 span | No cant.

February 10, 2020 09:01:54

Build 7239

Job name:

File name: MOUNTAINASH 3 EL 3.mxd

Address:

Description: 2ND FLR FRAMING\Dropped Beams\B15C DR(i2381)

City, Province, Postal Code: WATERDOWN


Specifier:

Customer:

Designer: AJ

Code reports: CCMC 12472-R

Company:

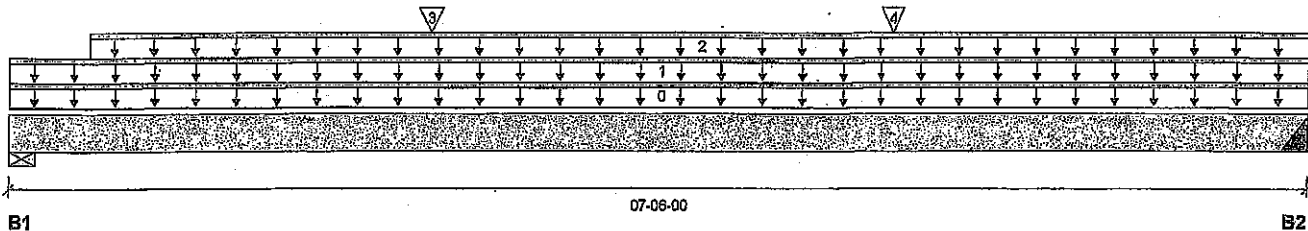

Total Horizontal Product Length = 07-06-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/2"	84 / 0	478 / 0	86 / 0	
B2, 4"	86 / 0	465 / 0	82 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	07-06-00	Top		10			00-00-00
1	WALL	Unf. Lin. (lb/ft)	L	00-00-00	07-06-00	Top		100			n/a
2	R1(i2378)	Unf. Lin. (lb/ft)	L	00-05-08	07-06-00	Top	12	6			n/a
3	WINDOW	Conc. Pt. (lbs)	L	02-05-00	02-05-00	Top	44	40	84		n/a
4	WINDOW	Conc. Pt. (lbs)	L	05-01-00	05-01-00	Top	44	40	84		n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/ Resistance	Case	Location
Pos. Moment	1060 ft-lbs	15093 ft-lbs	7.0%	0	03-10-00
End Shear	471 lbs	7521 lbs	6.3%	0	01-03-00
Total Load Deflection	L/999 (0.019")	n/a	n/a	35	03-10-00
Live Load Deflection	L/999 (0.006")	n/a	n/a	51	03-10-00
Max Defl.	0.019"	n/a	n/a	35	03-10-00
Span / Depth	8.6				

Bearing Supports

	Dim. (LxW)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material
B1	Wall/Plate 5-1/2" x 3-1/2"	669 lbs	4.0%	4.4%	Spruce-Pine-Fir
B2	Hanger 4" x 3-1/2"	651 lbs	n/a	5.9%	HGUS410

Cautions

Header for the hanger HGUS410 at B2 is a Double 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF.
Hanger model HGUS410 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.



PROJ NO. TAM5948-20
STRUCTURAL
COMPONENT ONLY



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Dropped Beams\B15C DR(i2381) (Dropped Beam)**

Dry | 1 span | No cant

February 10, 2020 09:01:54

BC CALC® Member Report
Build 7239

Job name:

File name: MOUNTAINASH 3 EL 3.mmdl

Address:

Description: 2ND FLR FRAMING\Dropped Beams\B15C DR(i2381)

City, Province, Postal Code: WATERDOWN

Specifier:

Customer:

Designer: AJ

Code reports: CCMC 12472-R

Company:

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume unbraced length of Top: 00-00-00, Bottom: 00-00-00.

CONFORMS TO OBC 2012

Hanger Manufacturer: Unassigned

AMENDED 2020


Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9



PROVIDE 3 ROWS OF 3/2" ARDOX
SPIRAL NAILS @ 12" O/C FOR
MULTI-PLY NAILING. MAINTAIN
A MIN. 2" LUMBER EDGE/END
DISTANCE. DO NOT USE AIR NAILS



DWG NO. TAM 5948-20

STRUCTURAL

COMPONENT ONLY



Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJST™, ALLJOIST®, BC RIM BOARD™, BCi®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

Maximum Floor Spans



Live Load = 40 psf, Dead Load = 30 psf
Simple Spans, L/480 Deflection Limit
3/4" OSB G&N Sheathing



Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-2"	13'-4"	12'-4"	15'-7"	14'-2"	13'-4"	12'-4"
	NI-40x	17'-0"	16'-0"	15'-1"	13'-11"	17'-5"	16'-1"	15'-1"	13'-11"
	NI-60	17'-2"	16'-2"	15'-5"	14'-3"	17'-6"	16'-5"	15'-5"	14'-3"
	NI-70	18'-0"	16'-11"	16'-3"	15'-6"	18'-5"	17'-3"	16'-7"	15'-6"
	NI-80	18'-3"	17'-1"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	15'-10"
11-7/8"	NI-20	17'-10"	16'-10"	16'-0"	14'-10"	18'-6"	17'-1"	16'-0"	14'-10"
	NI-40x	19'-4"	17'-11"	17'-3"	15'-10"	19'-11"	18'-6"	17'-9"	15'-10"
	NI-60	19'-7"	18'-2"	17'-5"	16'-9"	20'-2"	18'-9"	17'-11"	17'-1"
	NI-70	20'-9"	19'-2"	18'-3"	17'-5"	21'-4"	19'-9"	18'-10"	17'-10"
	NI-80	21'-1"	19'-5"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
14"	NI-90x	21'-8"	20'-0"	19'-1"	18'-0"	22'-2"	20'-6"	19'-6"	18'-6"
	NI-40x	21'-5"	19'-10"	18'-11"	17'-5"	22'-1"	20'-6"	19'-6"	17'-5"
	NI-60	21'-10"	20'-2"	19'-3"	18'-2"	22'-5"	20'-10"	19'-11"	18'-10"
	NI-70	23'-0"	21'-3"	20'-3"	19'-2"	23'-8"	21'-11"	20'-10"	19'-9"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
16"	NI-90x	24'-1"	22'-3"	21'-2"	20'-0"	24'-8"	22'-10"	21'-9"	20'-7"
	NI-60	23'-9"	22'-0"	20'-11"	19'-10"	24'-6"	22'-9"	21'-8"	20'-6"
	NI-70	25'-1"	23'-2"	22'-0"	20'-10"	25'-9"	23'-10"	22'-9"	21'-6"
	NI-80	25'-6"	23'-6"	22'-4"	21'-2"	26'-1"	24'-2"	23'-1"	21'-10"
	NI-90x	26'-4"	24'-3"	23'-1"	21'-10"	26'-11"	24'-11"	23'-8"	22'-5"

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-2"	13'-4"	12'-4"	15'-7"	14'-2"	13'-4"	12'-4"
	NI-40x	17'-9"	16'-1"	15'-1"	13'-11"	17'-9"	16'-1"	15'-1"	13'-11"
	NI-60	18'-1"	16'-5"	15'-5"	14'-3"	18'-1"	16'-5"	15'-5"	14'-3"
	NI-70	19'-10"	17'-11"	16'-9"	15'-6"	19'-10"	17'-11"	16'-9"	15'-6"
	NI-80	20'-2"	18'-3"	17'-1"	15'-10"	20'-2"	18'-3"	17'-1"	15'-10"
11-7/8"	NI-20	18'-10"	17'-1"	16'-0"	14'-10"	18'-10"	17'-1"	16'-0"	14'-10"
	NI-40x	21'-3"	19'-3"	17'-9"	15'-10"	21'-3"	19'-3"	17'-9"	15'-10"
	NI-60	21'-9"	19'-8"	18'-5"	17'-1"	21'-9"	19'-8"	18'-5"	17'-1"
	NI-70	23'-4"	21'-5"	20'-1"	18'-6"	23'-8"	21'-5"	20'-1"	18'-6"
	NI-80	23'-7"	21'-10"	20'-5"	18'-11"	24'-1"	21'-10"	20'-5"	18'-11"
14"	NI-90x	24'-3"	22'-6"	21'-3"	19'-7"	24'-8"	22'-7"	21'-3"	19'-7"
	NI-40x	24'-2"	21'-5"	19'-6"	17'-5"	24'-2"	21'-5"	19'-6"	17'-5"
	NI-60	24'-9"	22'-5"	21'-0"	19'-6"	24'-9"	22'-5"	21'-0"	19'-6"
	NI-70	26'-1"	24'-3"	22'-9"	21'-0"	26'-8"	24'-3"	22'-9"	21'-0"
	NI-80	26'-6"	24'-7"	23'-3"	21'-6"	27'-1"	24'-10"	23'-3"	21'-6"
16"	NI-90x	27'-3"	25'-4"	24'-1"	22'-4"	27'-9"	25'-10"	24'-3"	22'-4"
	NI-60	27'-3"	24'-11"	23'-5"	21'-7"	27'-6"	24'-11"	23'-5"	21'-7"
	NI-70	28'-8"	26'-8"	25'-3"	23'-4"	29'-3"	26'-11"	25'-3"	23'-4"
	NI-80	29'-1"	27'-0"	25'-9"	23'-10"	29'-8"	27'-6"	25'-10"	23'-10"
	NI-90x	29'-11"	27'-10"	26'-6"	24'-10"	30'-6"	28'-5"	26'-11"	24'-10"

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.



Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf



Simple Spans, L/480 Deflection Limit

5/8" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-2"	13'-9"	N/A	15'-7"	14'-8"	14'-2"	N/A
	NI-40x	16'-1"	15'-2"	14'-8"	N/A	16'-7"	15'-7"	15'-1"	N/A
	NI-60	16'-3"	15'-4"	14'-10"	N/A	16'-8"	15'-9"	15'-3"	N/A
	NI-70	17'-1"	16'-1"	15'-6"	N/A	17'-5"	16'-5"	15'-10"	N/A
	NI-80	17'-3"	16'-3"	15'-8"	N/A	17'-8"	16'-7"	16'-0"	N/A
11-7/8"	NI-20	16'-11"	16'-0"	15'-5"	N/A	17'-6"	16'-6"	16'-0"	N/A
	NI-40x	18'-1"	17'-0"	16'-5"	N/A	18'-9"	17'-6"	16'-11"	N/A
	NI-60	18'-4"	17'-3"	16'-7"	N/A	19'-0"	17'-8"	17'-1"	N/A
	NI-70	19'-6"	18'-0"	17'-4"	N/A	20'-1"	18'-7"	17'-9"	N/A
	NI-80	19'-9"	18'-3"	17'-6"	N/A	20'-4"	18'-10"	17'-11"	N/A
14"	NI-90x	20'-4"	18'-9"	17'-11"	N/A	20'-10"	19'-3"	18'-5"	N/A
	NI-40x	20'-1"	18'-7"	17'-10"	N/A	20'-10"	19'-4"	18'-6"	N/A
	NI-60	20'-5"	18'-11"	18'-1"	N/A	21'-2"	19'-7"	18'-9"	N/A
	NI-70	21'-7"	20'-0"	19'-1"	N/A	22'-3"	20'-7"	19'-8"	N/A
	NI-80	21'-11"	20'-3"	19'-4"	N/A	22'-7"	20'-11"	20'-0"	N/A
16"	NI-90x	22'-7"	20'-11"	19'-11"	N/A	23'-3"	21'-6"	20'-6"	N/A
	NI-60	22'-3"	20'-8"	19'-9"	N/A	23'-1"	21'-5"	20'-6"	N/A
	NI-70	23'-6"	21'-9"	20'-9"	N/A	24'-3"	22'-5"	21'-5"	N/A
	NI-80	23'-11"	22'-1"	21'-1"	N/A	24'-8"	22'-10"	21'-9"	N/A
	NI-90x	24'-8"	22'-9"	21'-9"	N/A	25'-4"	23'-5"	22'-4"	N/A

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-8"	15'-3"	14'-5"	N/A	16'-8"	15'-3"	14'-5"	N/A
	NI-40x	17'-11"	16'-11"	16'-1"	N/A	18'-5"	17'-1"	16'-1"	N/A
	NI-60	18'-2"	17'-1"	16'-4"	N/A	18'-7"	17'-4"	16'-4"	N/A
	NI-70	19'-2"	17'-10"	17'-2"	N/A	19'-7"	18'-3"	17'-7"	N/A
	NI-80	19'-5"	18'-0"	17'-4"	N/A	19'-10"	18'-5"	17'-8"	N/A
11-7/8"	NI-20	19'-6"	18'-1"	17'-3"	N/A	19'-11"	18'-3"	17'-3"	N/A
	NI-40x	21'-0"	19'-6"	18'-8"	N/A	21'-7"	20'-2"	19'-2"	N/A
	NI-60	21'-4"	19'-9"	18'-11"	N/A	21'-11"	20'-4"	19'-6"	N/A
	NI-70	22'-6"	20'-10"	19'-11"	N/A	23'-0"	21'-5"	20'-5"	N/A
	NI-80	22'-9"	21'-1"	20'-1"	N/A	23'-3"	21'-7"	20'-8"	N/A
14"	NI-90x	23'-4"	21'-8"	20'-8"	N/A	23'-10"	22'-2"	21'-2"	N/A
	NI-40x	23'-7"	21'-11"	20'-11"	N/A	24'-3"	22'-7"	21'-7"	N/A
	NI-60	24'-0"	22'-3"	21'-3"	N/A	24'-8"	22'-11"	21'-11"	N/A
	NI-70	25'-3"	23'-4"	22'-3"	N/A	25'-10"	24'-0"	22'-11"	N/A
	NI-80	25'-7"	23'-8"	22'-7"	N/A	26'-2"	24'-4"	23'-2"	N/A
16"	NI-90x	26'-4"	24'-4"	23'-3"	N/A	26'-10"	24'-11"	23'-9"	N/A
	NI-60	26'-5"	24'-6"	23'-4"	N/A	27'-2"	25'-3"	24'-2"	N/A
	NI-70	27'-9"	25'-8"	24'-6"	N/A	28'-5"	26'-5"	25'-2"	N/A
	NI-80	28'-2"	26'-1"	24'-10"	N/A	28'-10"	26'-9"	25'-6"	N/A
	NI-90x	29'-0"	26'-10"	25'-7"	N/A	29'-7"	27'-5"	26'-2"	N/A

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-1274C.




Maximum Floor Spans

Live Load = 40 psf; Dead Load = 15 psf
Simple Spans, L/480 Deflection Limit
3/4" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-10"	15'-0"	14'-5"	13'-5"	16'-4"	15'-5"	14'-5"	13'-5"
	NI-40x	17'-0"	16'-0"	15'-5"	14'-9"	17'-5"	16'-5"	15'-10"	15'-2"
	NI-60	17'-2"	16'-2"	15'-7"	14'-11"	17'-6"	16'-7"	15'-11"	15'-3"
	NI-70	18'-0"	16'-11"	16'-3"	15'-7"	18'-5"	17'-3"	16'-7"	15'-11"
	NI-80	18'-3"	17'-1"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	16'-1"
11-7/8"	NI-20	17'-10"	16'-10"	16'-2"	15'-6"	18'-6"	17'-4"	16'-9"	16'-1"
	NI-40x	19'-4"	17'-11"	17'-3"	16'-6"	19'-11"	18'-6"	17'-9"	17'-0"
	NI-60	19'-7"	18'-2"	17'-5"	16'-9"	20'-2"	18'-9"	17'-11"	17'-2"
	NI-70	20'-9"	19'-2"	18'-3"	17'-5"	21'-4"	19'-9"	18'-10"	17'-10"
	NI-80	21'-1"	19'-5"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
14"	NI-90x	21'-8"	20'-0"	19'-1"	18'-0"	22'-2"	20'-6"	19'-6"	18'-6"
	NI-40x	21'-5"	19'-10"	18'-11"	17'-11"	22'-1"	20'-6"	19'-7"	18'-7"
	NI-60	21'-10"	20'-2"	19'-3"	18'-2"	22'-5"	20'-10"	19'-11"	18'-10"
	NI-70	23'-0"	21'-3"	20'-3"	19'-2"	23'-8"	21'-11"	20'-10"	19'-9"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
16"	NI-90x	24'-1"	22'-3"	21'-2"	20'-0"	24'-8"	22'-10"	21'-9"	20'-7"
	NI-60	23'-9"	22'-0"	20'-11"	19'-10"	24'-6"	22'-9"	21'-8"	20'-6"
	NI-70	25'-1"	23'-2"	22'-0"	20'-10"	25'-9"	23'-10"	22'-9"	21'-6"
	NI-80	25'-6"	23'-6"	22'-4"	21'-2"	26'-1"	24'-2"	23'-1"	21'-10"
	NI-90x	26'-4"	24'-3"	23'-1"	21'-10"	26'-11"	24'-11"	23'-8"	22'-5"

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-10"	15'-5"	14'-6"	13'-5"	16'-10"	15'-5"	14'-6"	13'-5"
	NI-40x	18'-8"	17'-2"	16'-3"	15'-2"	18'-10"	17'-2"	16'-3"	15'-2"
	NI-60	18'-11"	17'-6"	16'-6"	15'-6"	19'-2"	17'-6"	16'-6"	15'-5"
	NI-70	20'-0"	18'-7"	17'-9"	16'-7"	20'-5"	18'-11"	17'-10"	16'-7"
	NI-80	20'-3"	18'-10"	17'-11"	16'-10"	20'-8"	19'-3"	18'-2"	16'-10"
11-7/8"	NI-20	20'-1"	18'-5"	17'-5"	16'-2"	20'-1"	18'-5"	17'-5"	16'-2"
	NI-40x	21'-10"	20'-4"	19'-4"	17'-8"	22'-5"	20'-6"	19'-4"	17'-8"
	NI-60	22'-1"	20'-7"	19'-7"	18'-4"	22'-8"	20'-10"	19'-8"	18'-4"
	NI-70	23'-4"	21'-8"	20'-8"	19'-7"	23'-10"	22'-3"	21'-2"	19'-9"
	NI-80	23'-7"	21'-11"	20'-11"	19'-9"	24'-1"	22'-6"	21'-5"	20'-0"
14"	NI-90x	24'-3"	22'-6"	21'-6"	20'-4"	24'-8"	23'-0"	22'-0"	20'-9"
	NI-40x	24'-5"	22'-9"	21'-6"	19'-5"	25'-1"	23'-2"	21'-9"	19'-5"
	NI-60	24'-10"	23'-1"	22'-0"	20'-10"	25'-6"	23'-8"	22'-4"	20'-10"
	NI-70	26'-1"	24'-3"	23'-2"	21'-10"	26'-8"	24'-11"	23'-9"	22'-4"
	NI-80	26'-6"	24'-7"	23'-5"	22'-2"	27'-1"	25'-3"	24'-1"	22'-9"
16"	NI-90x	27'-3"	25'-4"	24'-1"	22'-9"	27'-9"	25'-11"	24'-8"	23'-4"
	NI-60	27'-3"	25'-5"	24'-2"	22'-10"	28'-0"	26'-2"	24'-9"	23'-1"
	NI-70	28'-8"	26'-8"	25'-4"	23'-11"	29'-3"	27'-4"	26'-1"	24'-8"
	NI-80	29'-1"	27'-0"	25'-9"	24'-4"	29'-8"	27'-9"	26'-5"	25'-0"
	NI-90x	29'-11"	27'-10"	26'-6"	25'-0"	30'-6"	28'-5"	27'-2"	25'-8"

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.



Maximum Floor Spans



Live Load = 40 psf; Dead Load = 30 psf
Simple Spans, L/480 Deflection Limit
5/8" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-1"	13'-3"	N/A	15'-7"	14'-1"	13'-3"	N/A
	NI-40x	16'-1"	15'-2"	14'-8"	N/A	16'-7"	15'-7"	15'-1"	N/A
	NI-60	16'-3"	15'-4"	14'-10"	N/A	16'-8"	15'-9"	15'-3"	N/A
	NI-70	17'-1"	16'-1"	15'-6"	N/A	17'-5"	16'-5"	15'-10"	N/A
	NI-80	17'-3"	16'-3"	15'-8"	N/A	17'-8"	16'-7"	16'-0"	N/A
11-7/8"	NI-20	16'-11"	16'-0"	15'-5"	N/A	17'-6"	16'-6"	16'-0"	N/A
	NI-40x	18'-1"	17'-0"	16'-5"	N/A	18'-9"	17'-6"	16'-11"	N/A
	NI-60	18'-4"	17'-3"	16'-7"	N/A	19'-0"	17'-8"	17'-1"	N/A
	NI-70	19'-6"	18'-0"	17'-4"	N/A	20'-1"	18'-7"	17'-9"	N/A
	NI-80	19'-9"	18'-3"	17'-6"	N/A	20'-4"	18'-10"	17'-11"	N/A
14"	NI-90x	20'-4"	18'-9"	17'-11"	N/A	20'-10"	19'-3"	18'-5"	N/A
	NI-40x	20'-1"	18'-7"	17'-10"	N/A	20'-10"	19'-4"	18'-6"	N/A
	NI-60	20'-5"	18'-11"	18'-1"	N/A	21'-2"	19'-7"	18'-9"	N/A
	NI-70	21'-7"	20'-0"	19'-1"	N/A	22'-3"	20'-7"	19'-8"	N/A
	NI-80	21'-11"	20'-3"	19'-4"	N/A	22'-7"	20'-11"	20'-0"	N/A
16"	NI-90x	22'-7"	20'-11"	19'-11"	N/A	23'-3"	21'-6"	20'-6"	N/A
	NI-20	22'-3"	20'-8"	19'-9"	N/A	23'-1"	21'-5"	20'-6"	N/A
	NI-70	23'-6"	21'-9"	20'-9"	N/A	24'-3"	22'-5"	21'-5"	N/A
	NI-80	23'-11"	22'-1"	21'-1"	N/A	24'-8"	22'-10"	21'-9"	N/A
	NI-90x	24'-8"	22'-9"	21'-9"	N/A	25'-4"	23'-5"	22'-4"	N/A

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-1"	13'-3"	N/A	15'-7"	14'-1"	13'-3"	N/A
	NI-40x	17'-9"	16'-1"	15'-1"	N/A	17'-9"	16'-1"	15'-1"	N/A
	NI-60	18'-1"	16'-4"	15'-4"	N/A	18'-1"	16'-4"	15'-4"	N/A
	NI-70	19'-2"	17'-10"	16'-9"	N/A	19'-7"	17'-10"	16'-9"	N/A
	NI-80	19'-5"	18'-0"	17'-1"	N/A	19'-10"	18'-3"	17'-1"	N/A
11-7/8"	NI-20	18'-9"	17'-0"	16'-0"	N/A	18'-9"	17'-0"	16'-0"	N/A
	NI-40x	21'-0"	19'-3"	17'-9"	N/A	21'-3"	19'-3"	17'-9"	N/A
	NI-60	21'-4"	19'-8"	18'-5"	N/A	21'-8"	19'-8"	18'-5"	N/A
	NI-70	22'-6"	20'-10"	19'-11"	N/A	23'-0"	21'-4"	20'-0"	N/A
	NI-80	22'-9"	21'-1"	20'-1"	N/A	23'-3"	21'-7"	20'-5"	N/A
14"	NI-90x	23'-4"	21'-8"	20'-8"	N/A	23'-10"	22'-2"	21'-2"	N/A
	NI-40x	23'-7"	21'-5"	19'-6"	N/A	24'-1"	21'-5"	19'-6"	N/A
	NI-60	24'-0"	22'-3"	21'-0"	N/A	24'-8"	22'-5"	21'-0"	N/A
	NI-70	25'-3"	23'-4"	22'-3"	N/A	25'-10"	24'-0"	22'-8"	N/A
	NI-80	25'-7"	23'-8"	22'-7"	N/A	26'-2"	24'-4"	23'-2"	N/A
16"	NI-90x	26'-4"	24'-4"	23'-3"	N/A	26'-10"	24'-11"	23'-9"	N/A
	NI-60	26'-5"	24'-6"	23'-4"	N/A	27'-2"	24'-10"	23'-4"	N/A
	NI-70	27'-9"	25'-8"	24'-6"	N/A	28'-5"	26'-5"	25'-2"	N/A
	NI-80	28'-2"	26'-1"	24'-10"	N/A	28'-10"	26'-9"	25'-5"	N/A
	NI-90x	29'-0"	26'-10"	25'-7"	N/A	29'-7"	27'-5"	26'-2"	N/A

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.

1w-1

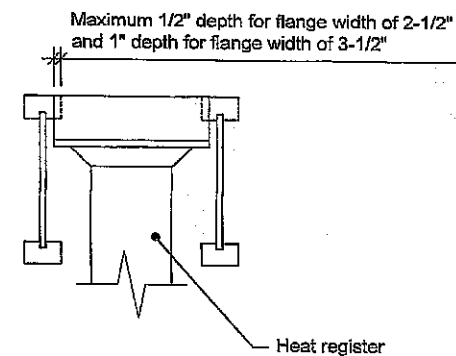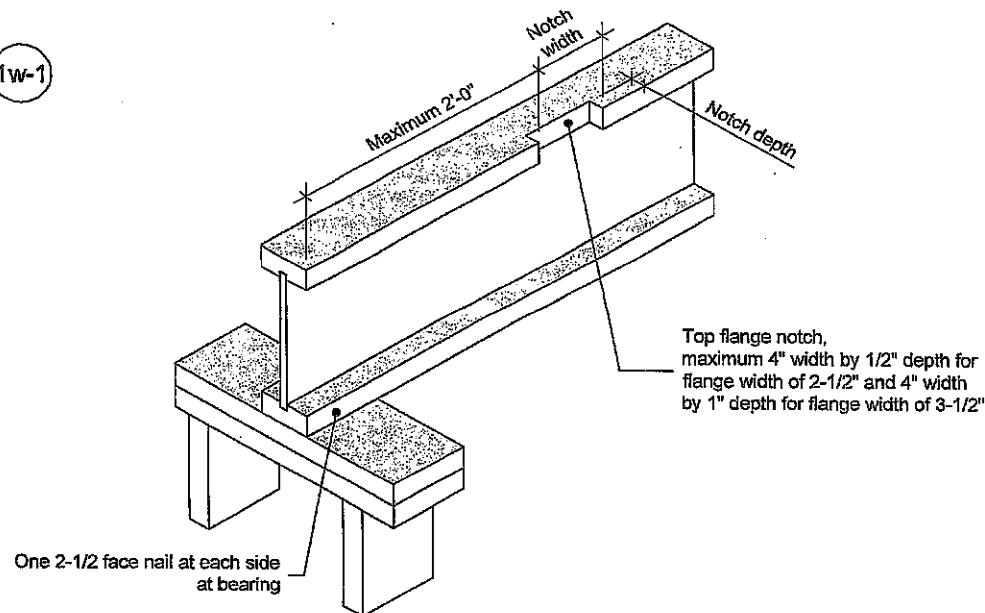

Notes:

1. Blocking required at bearing for lateral support, not shown for clarity.
2. The maximum dimensions for a notch on the side of the top flange are 4-inch width by 1/2-inch depth for flange width of 2-1/2 inches, and 4-inch width by 1-inch depth for flange width of 3-1/2 inches.
3. This detail applies to simple-span joists and multiple-span joists where the notch is located at the end half-span.
4. For other applications, contact Nordic Structures.

This document supersedes all previous versions. If the document has been in effect for more than one year, consult nordic.ca or contact Nordic Structures.

All nails shown in the details are assumed to be common nails unless otherwise noted. Nails shall have a diameter not less than 0.128 inch for 2-1/2-inch nails, or 0.144 inch for 3-inch nails. Individual components not shown to scale for clarity.

**NORDIC
STRUCTURES**

T 514-871-8526
1 866 817-3418

nordic.ca

TITLE

Notch in I-joist for Heat Register

CATEGORY

I-joist - Typical Floor Framing and Construction Details

DOCUMENT

-

DATE

2018-04-10

NUMBER

1w-1




Allowance for Piping (Installation Notes)

The floor layouts have usually not been checked for heating and/or plumbing interference. On-site adjustment of joists of up to 3 inches is permitted to avoid interferences. When moving a joist, the subfloor thickness shall be checked with code requirements when the joist spacing exceeds 19.2 inches. Except for cutting to length, I-joist flanges should never be cut, drilled, or notched.

Installation of Nordic I-joists shall be as per *Nordic Joist Installation Guide for Residential Floors*. Refer to Tables 1 and 2 for maximum web hole and duct chase openings, respectively. These tables are based on the I-joists being used at their maximum spans. The minimum distance given may be reduced for shorter spans; contact your distributor for additional information.

The detail below shows the 3-inch allowance for piping. Every third joist may be shifted up to 3 inches to avoid heating/plumbing interference. For other applications, please contact your distributor.

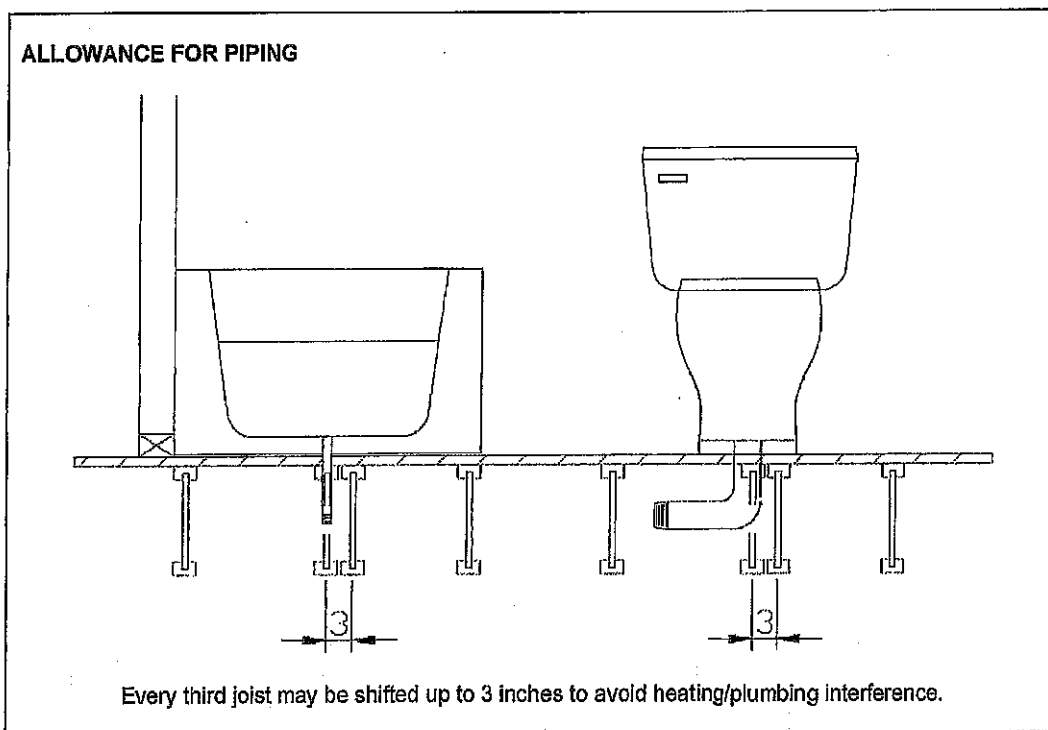

Revised April 12, 2012