


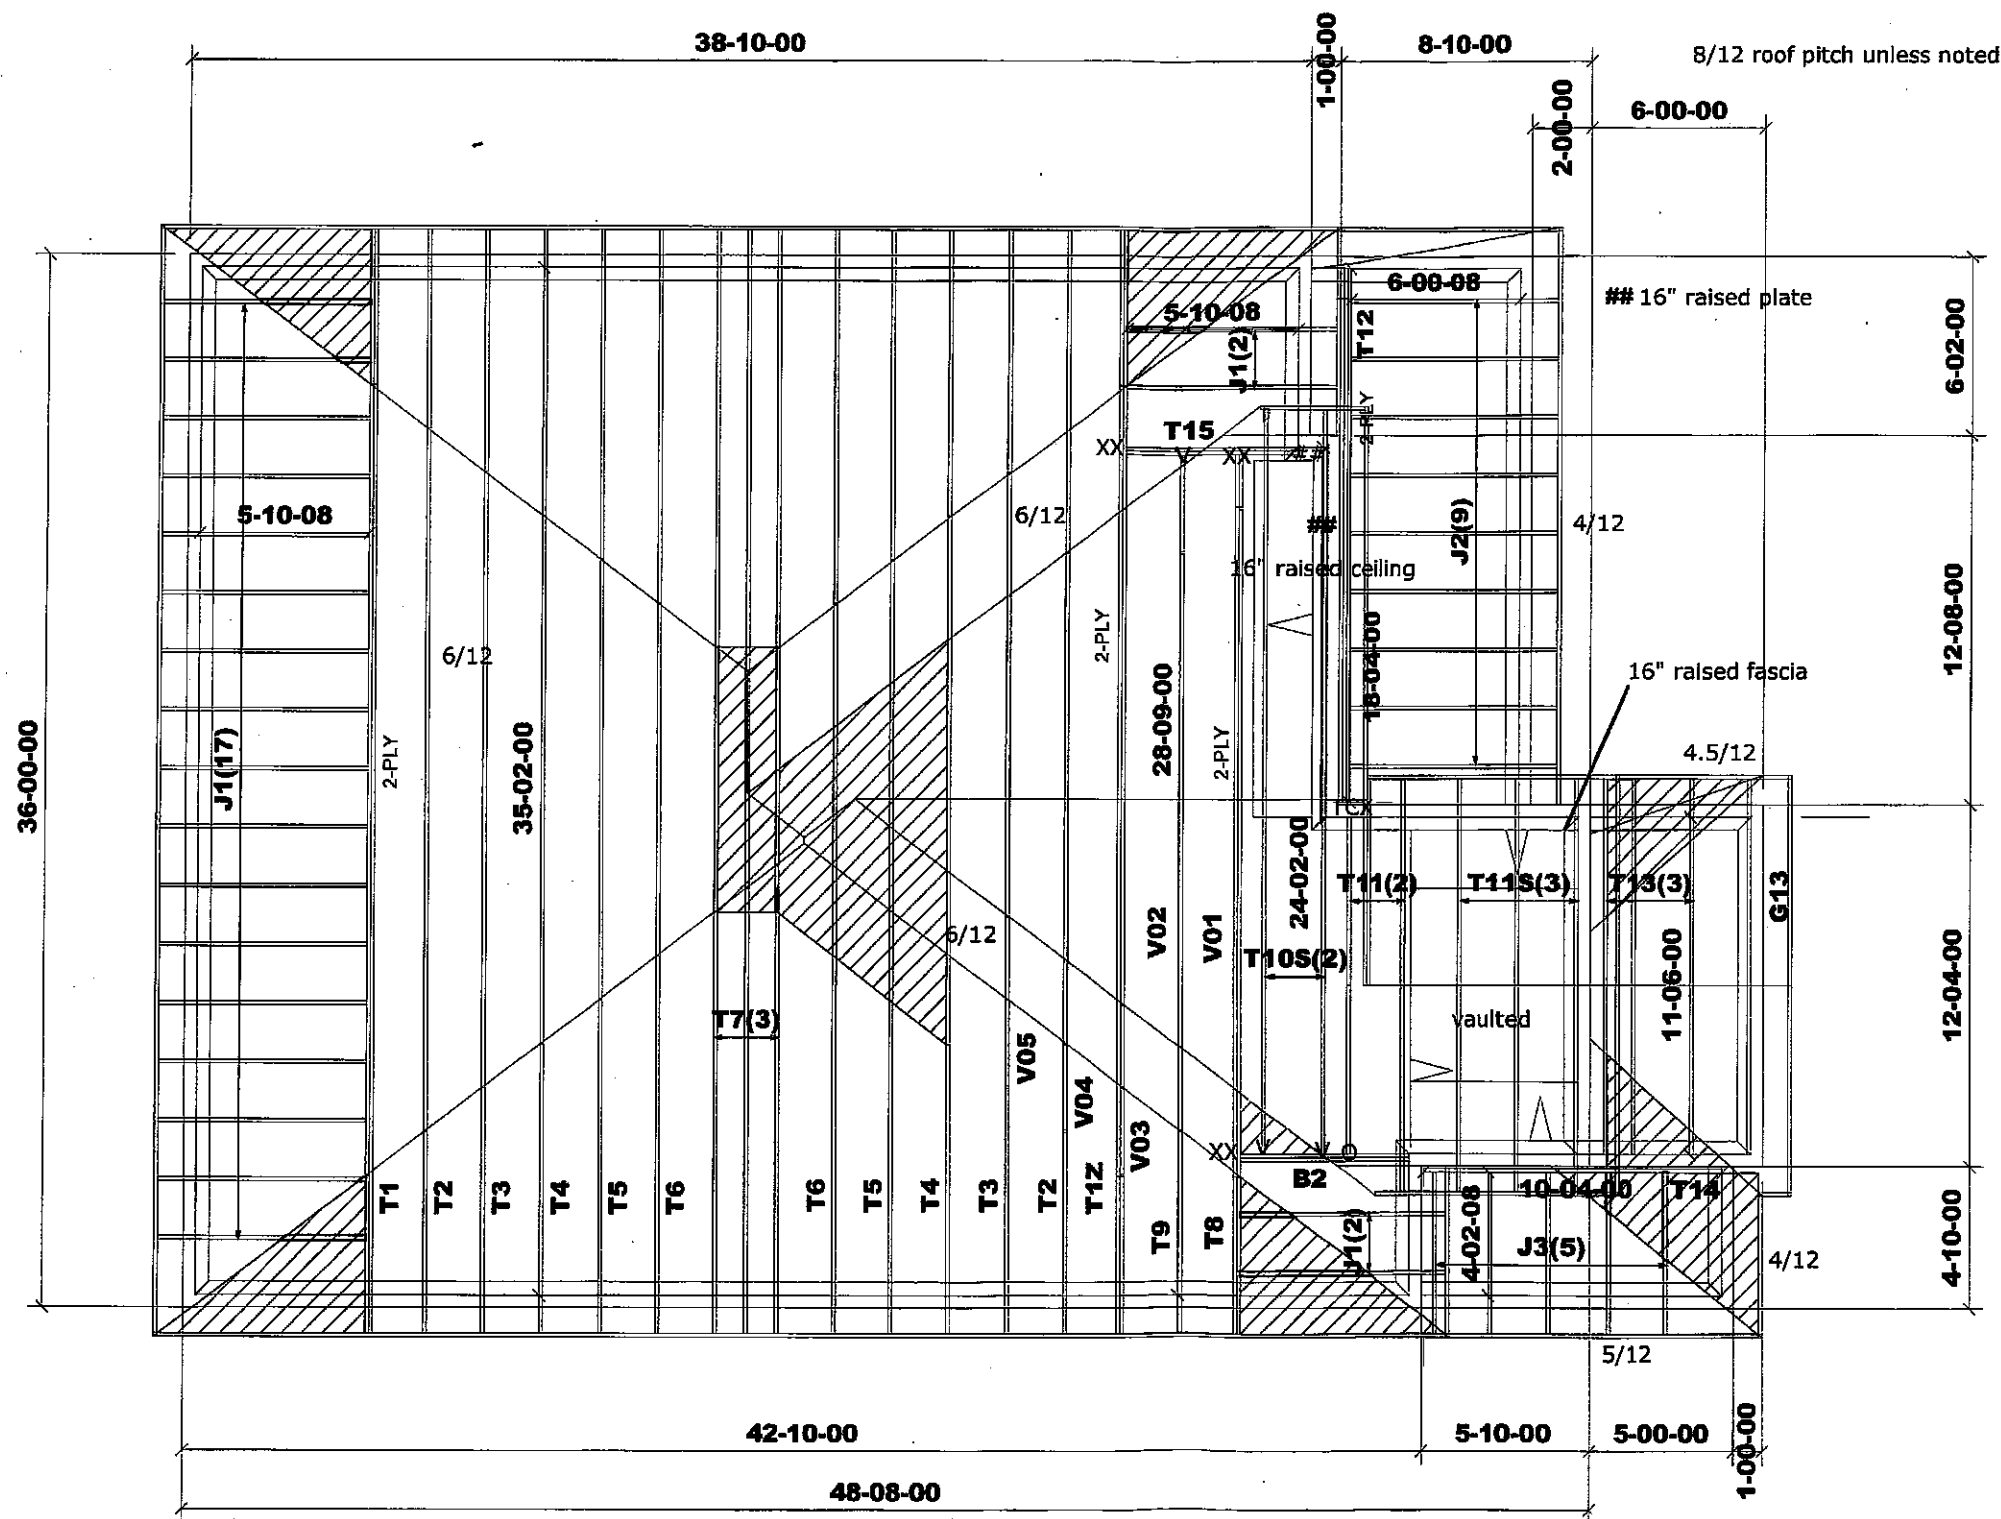

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)

BEAMS:
B2 = 2 - 2x10 SPF #2

 DENOTES:
CONVENTIONAL
FRAMING

CITY OF HAMILTON
Building Division

Permit No. 20-187720

THESE STAMPED DOCUMENTS SHALL BE AVAILABLE ON SITE
THE OWNER SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS
THESE DRAWINGS AND SPECIFICATIONS HAVE BEEN REVIEWED BY

Kem Smith Dec 14, 2020

M13123



Job Track: 51225
Plan Log: 202376
Layout ID: 408087

Builder / Location:
GREEN PARK HOMES / WATERDOWN

Project: RUSSELL GARDENS PH.3


Date: 2020-04-27 Sales: Mario DiCano

Designer: JG

Model / Elevation:
MOUNTAINASH 2/1 STD OR OPT.5 BR

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

Mitek ver 8.3.1.215

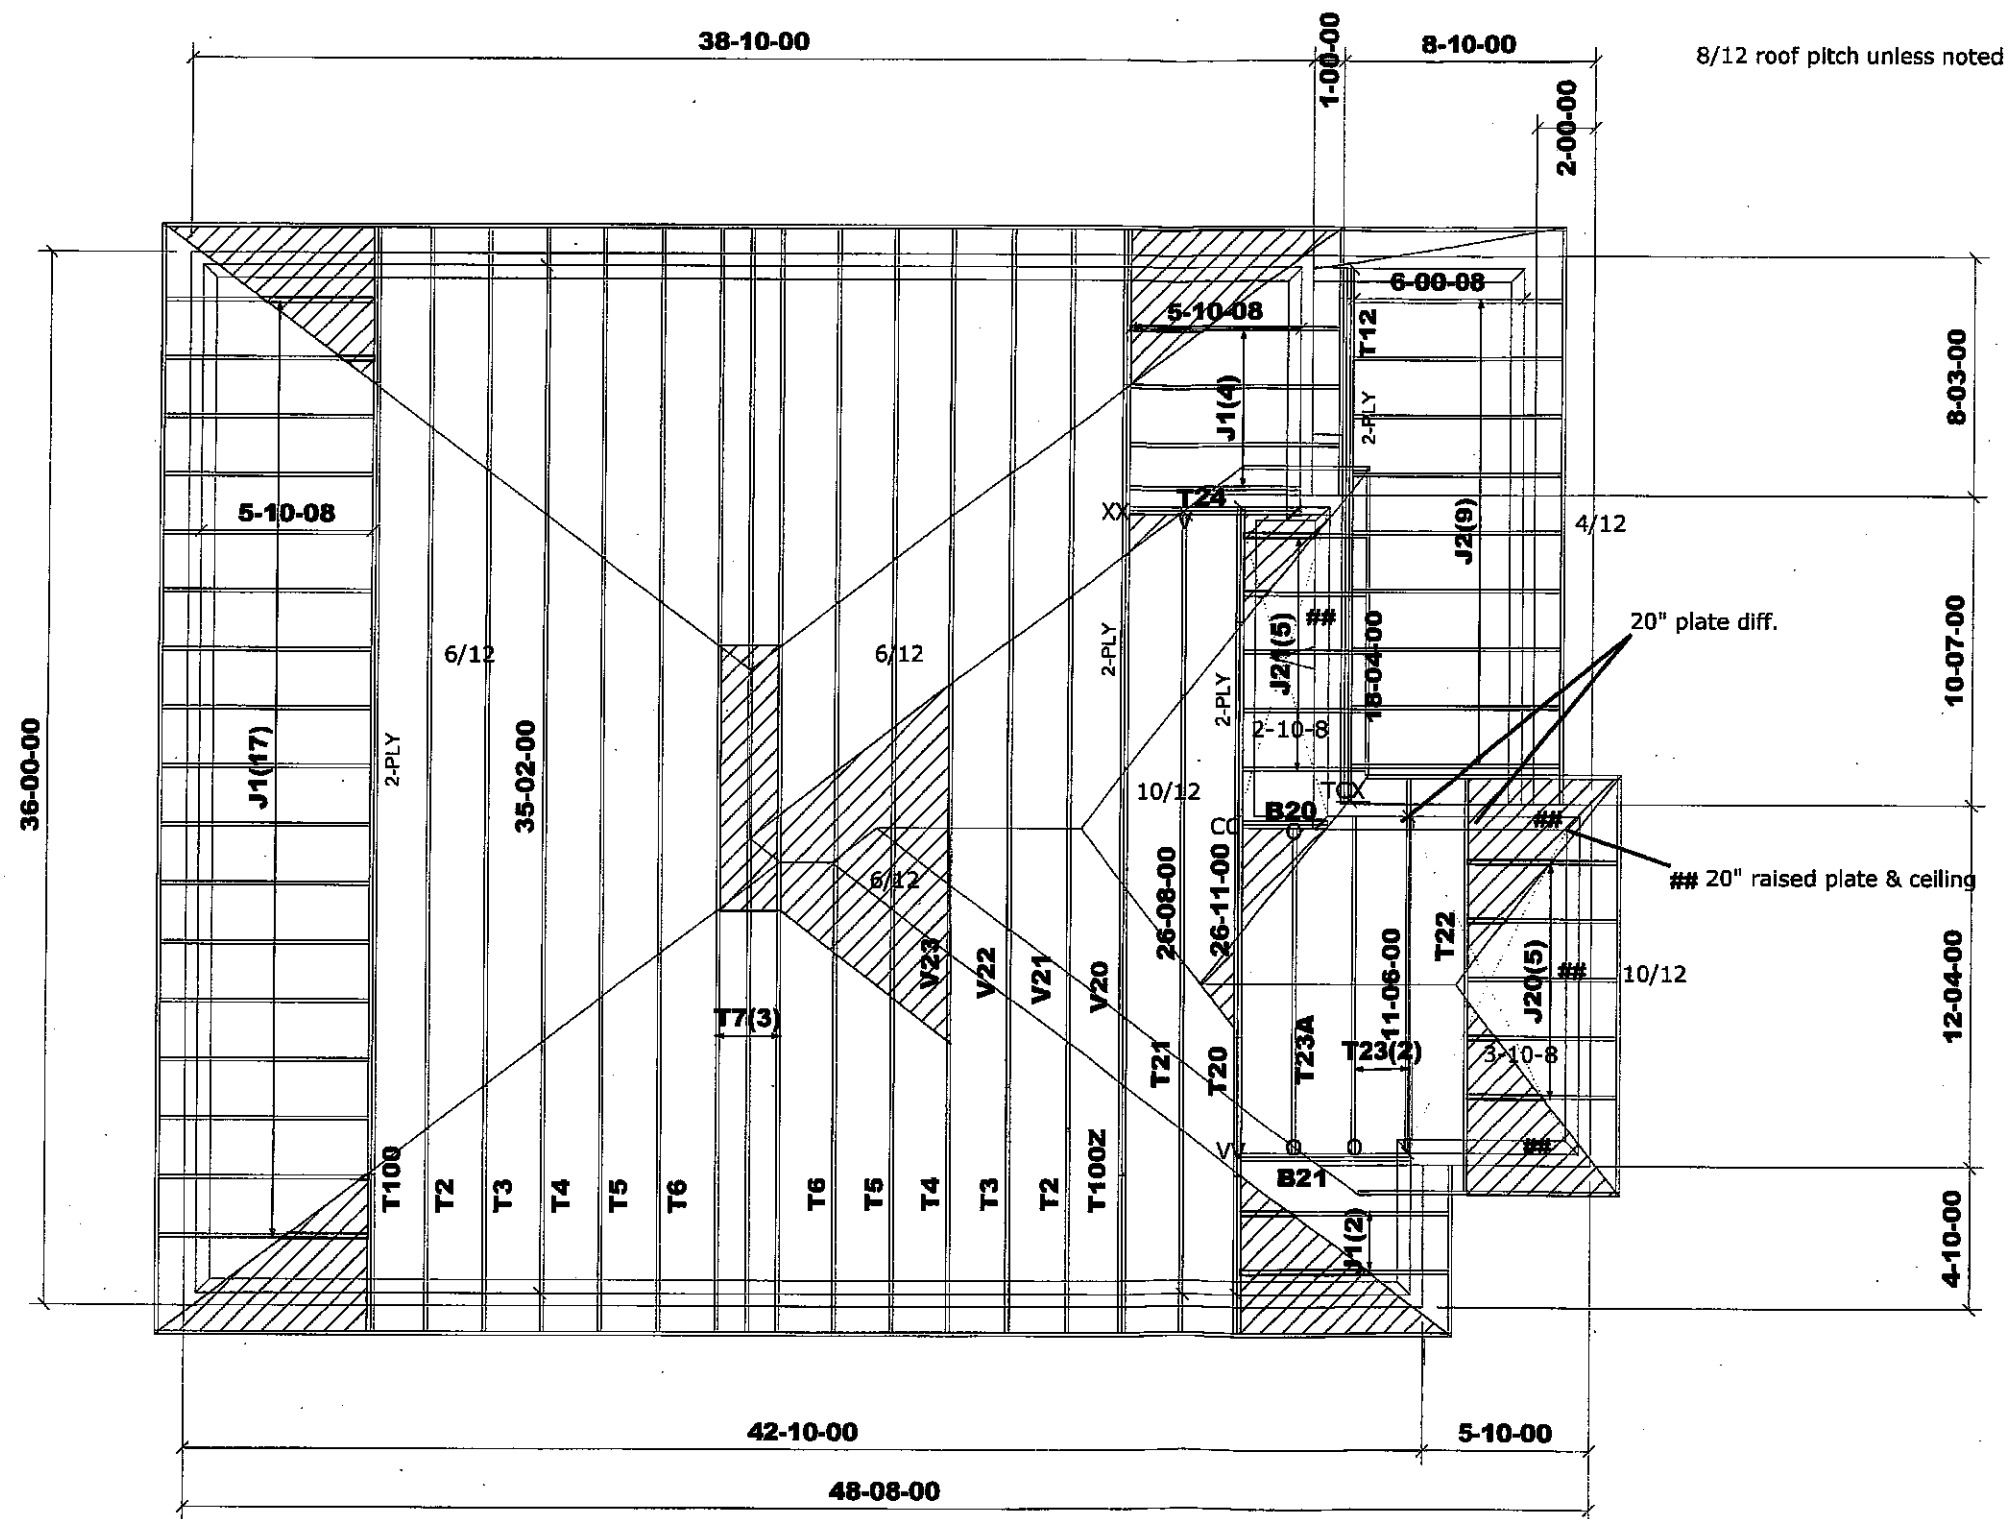

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.


DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
LUS26-2(VV)
HUSC 26-2- (CC)

BEAMS:
B20=B21 =
2 - 2x10 SPF #2

DENOTES: CONVENTIONAL FRAMING

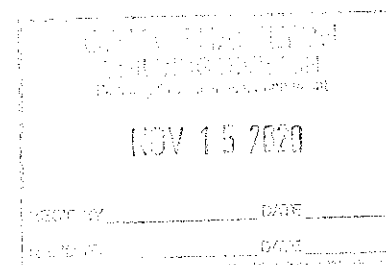

Permit No. 20-187720

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

M13123



Job Track: 51225
Plan Log: 202376
Layout ID: 408088

Builder / Location: GREEN PARK HOMES / WATERDOWN

Project: RUSSELL GARDENS PH.3

Date: 2020-04-27 Sales: Mario DiCano


Designer: JG

Model / Elevation: MOUNTAINASH 2/2 STD OR OPT.5 BR

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

Model ver 8.3.1.215

Dec 14, 2020

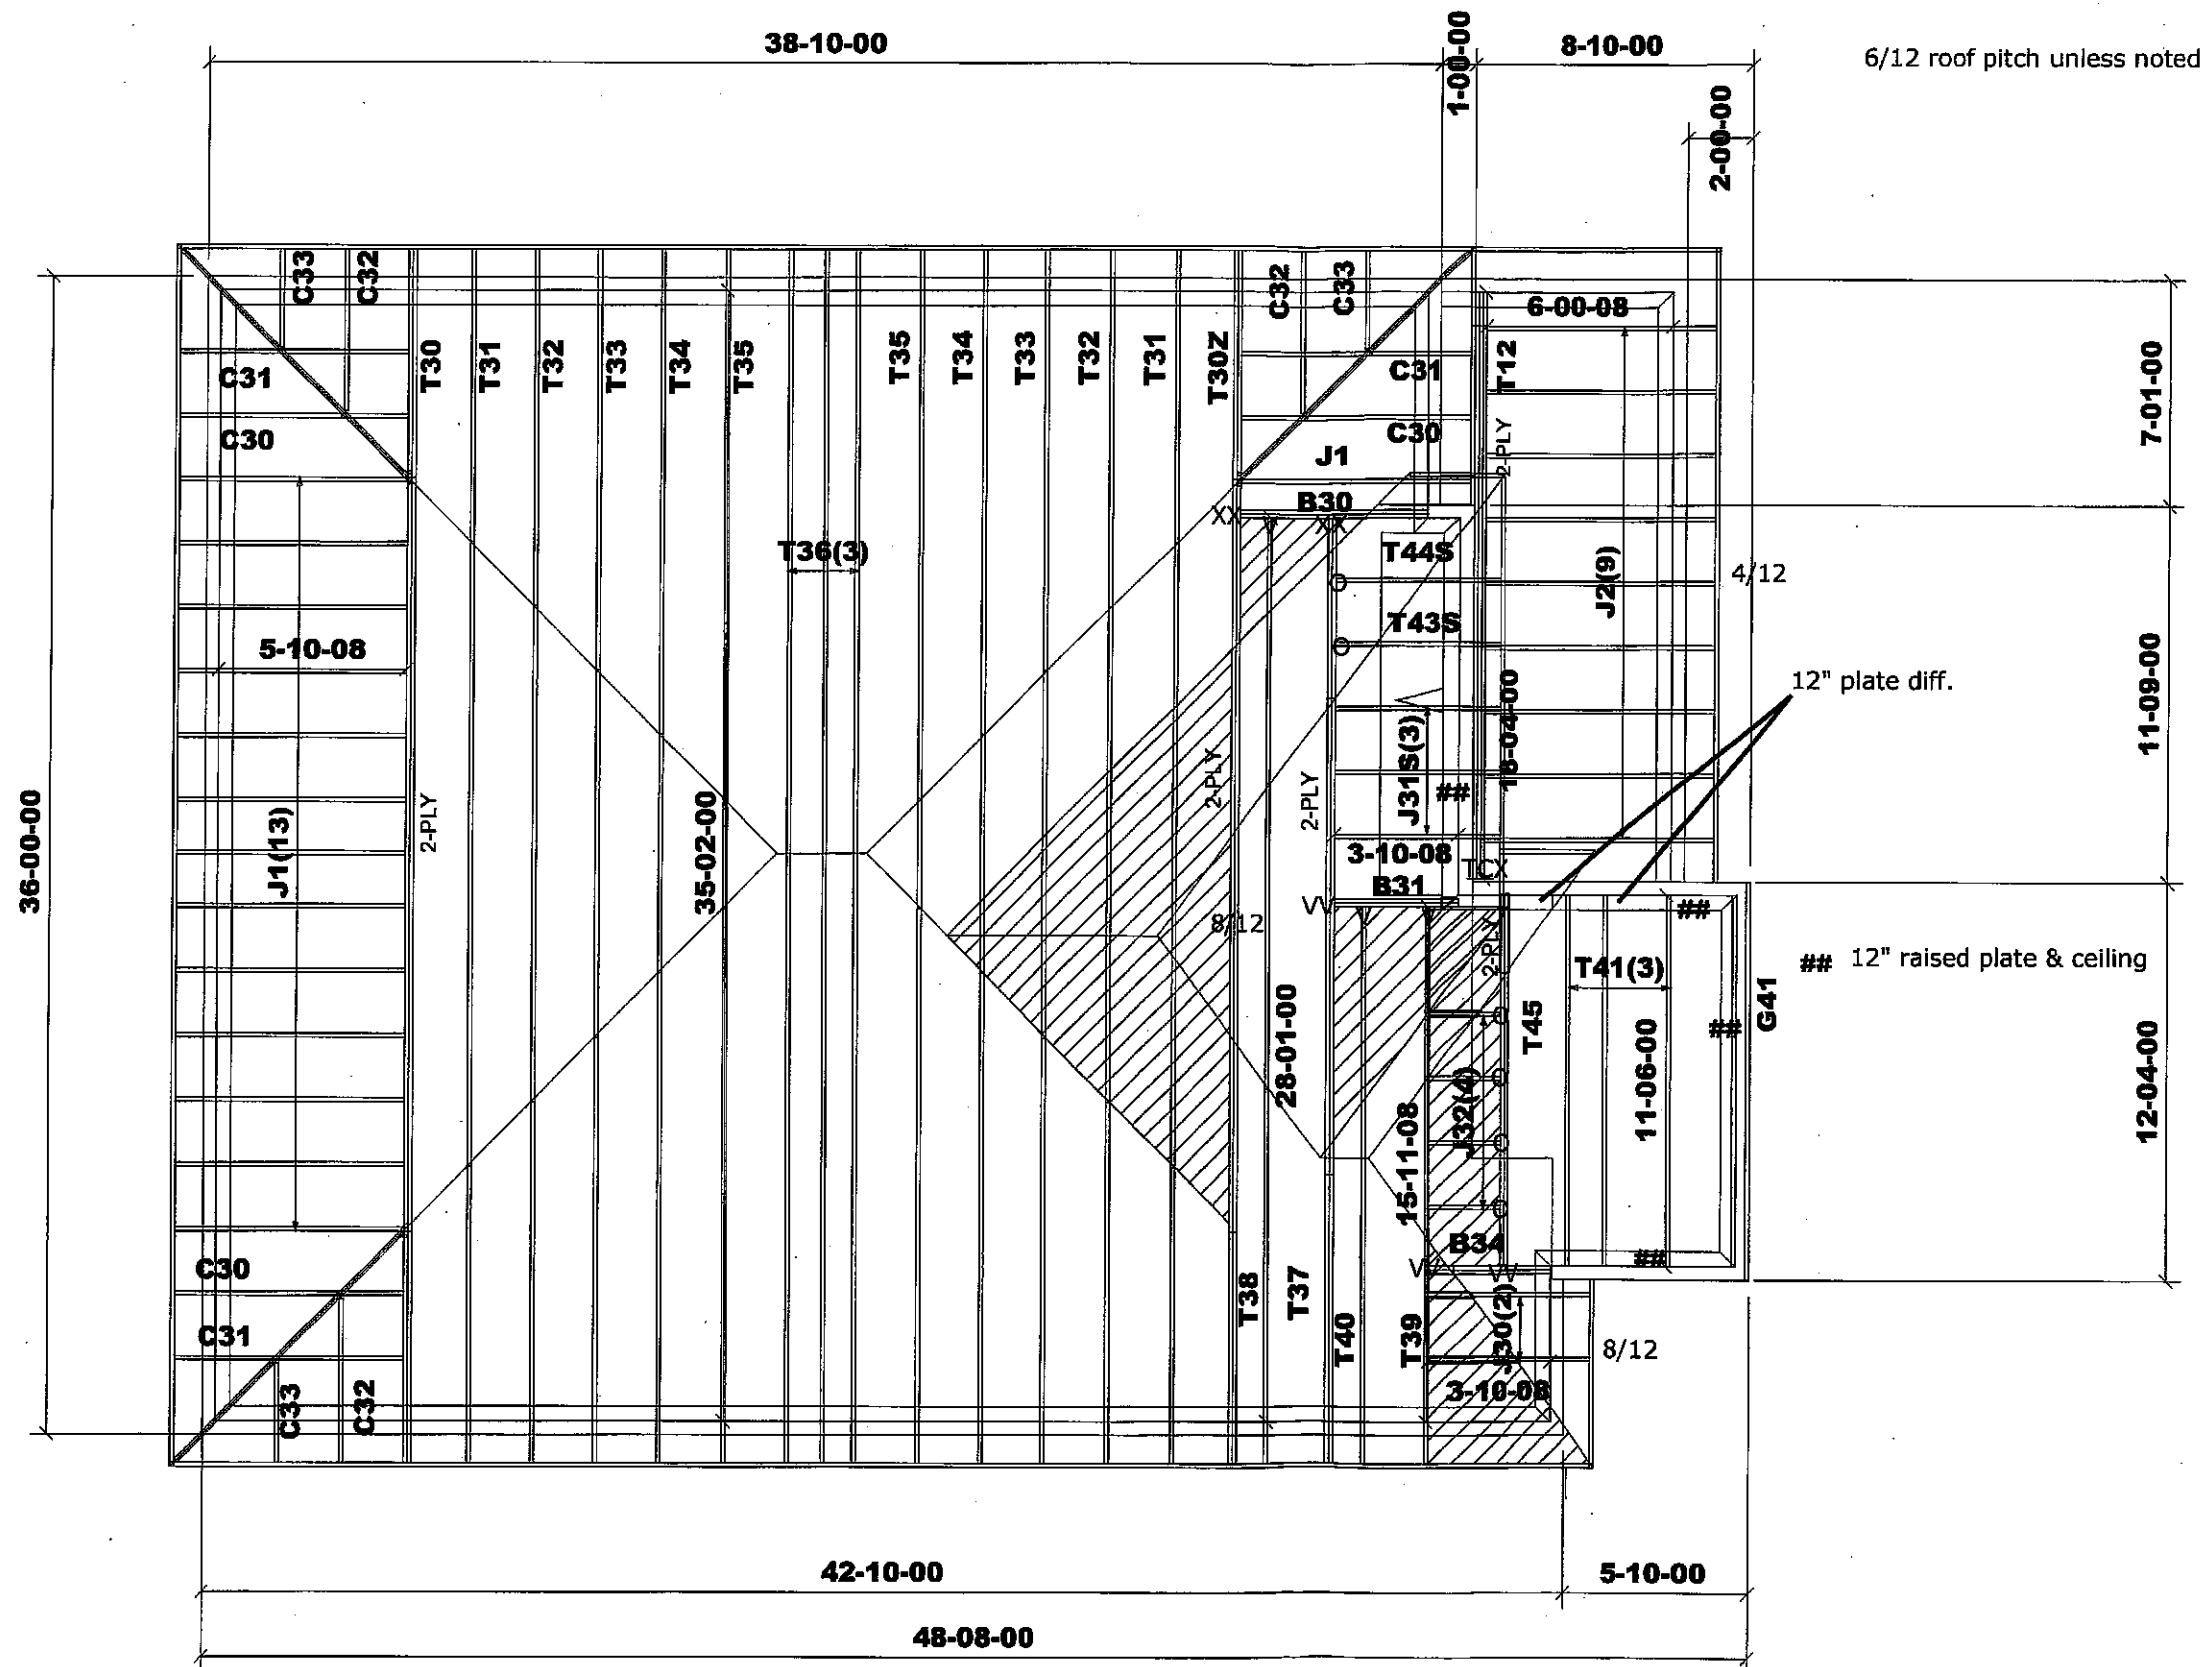

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment)
Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:


TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:

LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
LUS26-2(VV)

BEAMS:

B30=B31 = B34=
2 - 2x10 SPF #2



**DENOTES:
CONVENTIONAL
FRAMING**

CITY OF HAMILTON
Building Division

Permit No. 20 - 187720

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THESE DRAWINGS OR ANY PART THEREOF SHALL COMPLY WITH THE CITY OF HAMILTON BUILDING DEPARTMENT ORDINANCES AND ALL OTHER APPLICABLE LAWS

These drawings have been reviewed by

Dec 14, 2020

M13123



Job Track: 51225
Plan Log: 202376
Layout ID: 408089

Builder / Location:
GREEN PARK HOMES / WATERDOWN

Project: **RUSSELL GARDENS PH.3**

Date: 2020-04-27 Sales: Mario DiCano

Designer: JG

Model / Elevation:
MOUNTAINASH 2/3 STD OR OPT.5 BR

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 2
 Lot #:
 Elevation: 1 STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202376
 Layout ID: 408087
 Ref #
 Page: 1 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	8/12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	328.91 204.00		
	1 2-ply	T1Z Hip Girder	8/12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	328.91 204.00		
	2	T2 Hip	8/12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	279.73 177.00		
	2	T3 Hip	8/12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	302.74 191.33		
	2	T4 Hip	8/12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	309.1 195.67		
	2	T5 Hip	8/12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	316.76 198.67		
	2	T6 Hip	8/12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	329.25 205.00		
	3	T7 Hip	8/12	35-02-00	10-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	514.72 323.00		
	1 2-ply	T8 Hip Girder	8/12	28-09-00	4-01-04	2 x 4 2 x 6	1-03-08	1-04-13 2-10-13	284.12 165.00		
	1	T9 Hip	8/12	28-09-00	5-01-04	2 x 4	1-03-08	1-04-13 2-10-13	115.01 71.67		
	2	T10S Roof Special	8/12	24-02-00	10-09-08	2 x 4	1-03-08	2-08-13 1-04-13	243.66 152.67		
	2	T11 Common	8/12	11-06-00	6-06-13	2 x 4		2-08-13 2-08-13	97.68 63.33		
	3	T11S Roof Special	8/12 8/12	11-06-00	6-06-13	2 x 4	1-03-08 1-03-08	2-08-13 2-08-13	170.35 110.00		
	1 2-ply	T12 Flat Girder	0/12	18-04-00	2-04-02	2 x 6 2 x 4		2-04-02 2-04-02	154.37 94.00		

 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST			
	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 2 Lot #: Elevation: 1 STD OR OPT.5 BR	Job Track: 51225 PlanLog: 202376 Layout ID: 408087 Ref # Page: 2 of 3 Date: 04-27-2020 Designer: Sales Rep: Mario DiCano		

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	3	T13 Common	4.5 /12	11-06-00	2-11-07	2 x 4	1-03-08 1-03-08	4-10 4-10	98.28 59.00		
	1	G13 GABLE	4.5 /12	11-06-00	2-11-07	2 x 4	1-03-08 1-03-08	4-10 4-10	34.1 21.67		
	1	T14 Half Hip Girder	4 /12	10-04-00	2-02-06	2 x 4		3-15 2-02-06	37.41 24.17		
	1 2-ply	T15 Flat Girder	0 /12	5-10-08	1-04-00	2 x 4 2 x 6		1-04-00 1-04-00	46.53 29.67		
	1	V01 Valley	8 /12	19-10-07	6-07-08	2 x 4			58.93 36.33		
	1	V02 Valley	8 /12	16-10-07	5-07-08	2 x 4			48.95 30.17		
	1	V03 Valley	8 /12	22-08-07	6-07-08	2 x 4			67.82 42.33		
	1	V04 Valley	8 /12	19-08-07	5-07-08	2 x 4			57.84 36.17		
	1	V05 Valley	8 /12	16-08-07	4-07-08	2 x 4			48.74 29.67		
	21	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	352.64 224.00		
	9	J2 Jack-Open	4 /12	6-00-08	2-09-00	2 x 4	1-03-08	3-15 2-04-02	142.33 90.00		
	5	J3 Jack-Open	5 /12	4-02-08	2-07-05	2 x 4	1-03-08	5-06 2-02-06	62.65 43.33		

TOTAL # TRUSS= 76


TOTAL BFT OF ALL TRUSSES= 3019.85

BFT.

TOTAL WEIGHT OF ALL TRSSES 4807.58 LBS

HARDWARE


QTY	TYPE	MODEL	LENGTH
3	Hardware	LJS26DS	
1	Hardware	LUS24	

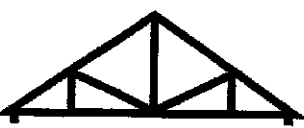DELIVERY SHIPLIST		
 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	Lumber Yard:	TAMARACK LUMBER
	Builder:	GREEN PARK HOMES
	Project:	RUSSELL GARDENS PH.3
	Location:	WATERDOWN
	Model:	MOUNTAINASH 2
	Lot #:	
	Elevation:	1 STD OR OPT.5 BR
Job Track:	51225	
PlanLog:	202376	
Layout ID:	408087	
Ref #		
Page:	3 of 3	
Date:	04-27-2020	
Designer:		
Sales Rep:	Mario DiCano	

HARDWARE






QTY	TYPE	MODEL	LENGTH
3	Hardware	HGUS26-2	

TOTAL NUMBER OF
ITEMS= 7

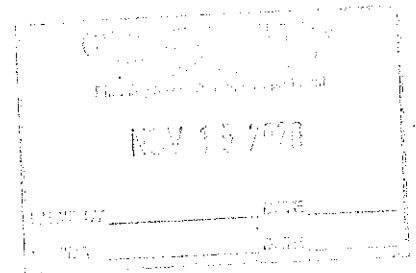



 TAMARACK ROOF TRUSSES INC. ALFA LUMBER GROUP	DELIVERY SHIPLIST				Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 2 Lot #: Elevation: 2 STD OR OPT.5 BR		Job Track: 51225 PlanLog: 202376 Layout ID: 408088 Ref # Page: 1 of 2 Date: 04-27-2020 Designer: Sales Rep: Mario DiCano	
---	--------------------------	--	--	--	---	--	---	--

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T2 Hip	8 /12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	279.73 177.00		
	2	T3 Hip	8 /12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	302.74 191.33		
	2	T4 Hip	8 /12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	309.1 195.67		
	2	T5 Hip	8 /12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	316.76 196.67		
	2	T6 Hip	8 /12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	329.26 205.00		
	3	T7 Hip	8 /12	35-02-00	10-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	514.72 323.00		
	1 2-ply	T12 Flat Girder	0 /12	18-04-00	2-04-02	2 x 6 2 x 4		2-04-02 2-04-02	154.37 94.00		
	1 2-ply	T20 Roof Special Girder	8 /12	26-11-00	5-08-06	2 x 4 2 x 6	1-03-08	1-04-13 1-04-13	284.52 180.67		
	1	T21 Roof Special	8 /12	26-08-00	7-04-06	2 x 4	1-03-08	1-04-13 3-02-13	126.32 80.50		
	1	T22 Hip Girder	8 /12	11-06-00	4-10-06	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	53.42 33.83		
	2	T23 Common	8 /12	11-06-00	6-10-13	2 x 4		3-00-13 3-00-13	100.2 64.33		
	1	T23A Common	8 /12	11-01-00	6-10-13	2 x 4		3-00-13 3-04-02	49.18 31.50		
	1 2-ply	T24 Flat Girder	0 /12	5-10-08	1-08-00	2 x 6		1-08-00 1-08-00	55.39 33.67		
	1 2-ply	T100 Hip Girder	8 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	320.63 198.67		

 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 2 Lot #: Elevation: 2 STD OR OPT.5 BR	Job Track: 51225 PlanLog: 202376 Layout ID: 408088 Ref # Page: 2 of 2 Date: 04-27-2020 Designer: Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T100Z Hip Girder	8 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	320.63 198.67		
	1	V20 Valley	8 /12	21-01-07	4-10-06	2 x 4			60.91 40.00		
	1	V21 Valley	8 /12	18-01-07	5-03-02	2 x 4			51.45 33.33		
	1	V22 Valley	8 /12	15-01-07	4-03-02	2 x 4			42.29 28.33		
	1	V23 Valley	8 /12	12-01-07	3-03-02	2 x 4			33.11 22.17		
	23	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	386.23 245.33		
	9	J2 Jack-Open	4 /12	6-00-08	2-09-00	2 x 4	1-03-08	3-15 2-04-02	142.33 90.00		
	5	J20 Jack-Open	10 /12	3-10-08	4-10-06	2 x 4	1-03-08	1-07-10 4-10-06	76.1 48.33		
	5	J21 Jack-Open	10 /12	2-10-08	4-00-06	2 x 4	1-03-08	1-07-10 4-00-06	62.98 41.67		

TOTAL # TRUSS= 74

TOTAL BFT OF ALL TRUSSES= 2753.67

BFT.


TOTAL WEIGHT OF ALL TRSSES 4372.39 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	LJS26DS	
3	Hardware	LUS24	
1	Hardware	LUS26-2	
1	Hardware	HGUS26-2	
1	Hardware	HUSC26-2	

TOTAL NUMBER OF
ITEMS=

7

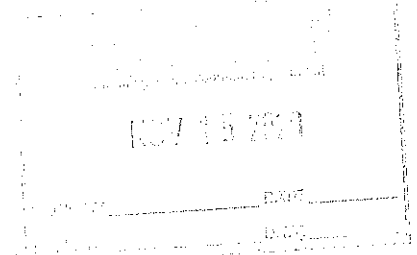



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 2
 Lot #:
 Elevation: 3 STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202376
 Layout ID: 408089
 Ref #
 Page: 1 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T12 Flat Girder	0 /12	18-04-00	2-04-02	2 x 6 2 x 4		2-04-02 2-04-02	154.37 94.00		
	1 2-ply	T30 Hip Girder	6 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	317.54 198.67		
	1 2-ply	T30Z Hip Girder	6 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	317.54 198.67		
	2	T31 Hip	6 /12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.89 174.00		
	2	T32 Hip	6 /12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.1 174.67		
	2	T33 Hip	6 /12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	289.07 179.67		
	2	T34 Hip	6 /12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	290.73 183.33		
	2	T35 Hip	6 /12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	309.55 196.00		
	3	T36 Common	6 /12	35-02-00	9-11-08	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	455.04 279.00		
	1 2-ply	T37 Hip Girder	6 /12	28-01-00	4-11-13	2 x 4 2 x 6	1-03-08	1-02-00 2-02-00	251.08 159.67		
	1	T38 Hip	6 /12	28-01-00	6-03-13	2 x 4	1-03-08	1-02-00 2-02-00	118.65 75.50		
	1	T39 Hip Girder	6 /12	15-11-08	3-11-13	2 x 4 2 x 6	1-03-08	1-02-00 1-04-04	70.36 44.67		
	1	T40 Common	6 /12	15-11-08	5-03-00	2 x 4	1-03-08	1-02-00 1-04-04	61.19 37.83		
	3	T41 Flat	0 /12	11-06-00	4-00-00	2 x 4		4-00-00 4-00-00	141.44 91.00		



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 2
 Lot #:
 Elevation: 3 STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202376
 Layout ID: 408089
 Ref #
 Page: 2 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T43S Half Hip	8 /12	3-10-08	4-01-04	2 x 4	1-03-08	1-04-13 4-01-04	28.35 18.33		
	1	T44S Half Hip	8 /12	3-10-08	3-01-04	2 x 4	1-03-08	1-04-13 3-01-04	23.91 17.50		
	1 2-ply	T45 Flat Girder	0 /12	11-06-00	2-04-02	2 x 4		2-04-02 2-04-02	85.38 53.33		
	14	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	235.1 149.33		
	9	J2 Jack-Open	4 /12	6-00-08	2-09-00	2 x 4	1-03-08	3-15 2-04-02	142.33 90.00		
	2	J30 Jack-Open	8 /12	3-10-08	3-11-13	2 x 4	1-03-08	1-04-13 3-11-13	28.34 18.00		
	3	J31S Jack-Open	8 /12	3-10-08	4-11-13	2 x 4	1-03-08	1-04-13 4-11-13	82.8 57.50		
	4	J32 Jack-Open	8 /12	2-02-08	3-11-13	2 x 4		2-06-02 3-11-13	40.96 30.00		
	3	C30 Jack-Open	6 /12	3-09-08	3-00-12	2 x 4	1-03-08 2-01-00	1-02-00 3-00-12	42.4 26.00		
	3	C31 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	34.75 22.00		
	3	C32 Jack-Open	6 /12	1-10-08	3-00-11	2 x 4	1-03-08 1-10-14	1-02-00 2-01-04	28.7 18.00		
	3	C33 Jack-Open	6 /12	1-09-06	2-00-11	2 x 4	1-03-08 1-02	1-02-00 2-00-11	21.05 14.00		
	1	G41 GABLE	0 /12	11-06-00	4-00-00	2 x 4		4-00-00 4-00-00	47.93 31.33		

TOTAL # TRUSS= 76

TOTAL BFT OF ALL TRUSSES= 2632


BFT. TOTAL WEIGHT OF ALL TRSSES 4171.63 LBS

 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP		DELIVERY SHIPLIST	
		Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 2 Lot #: Elevation: 3 STD OR OPT.5 BR	Job Track: 51225 PlanLog: 202376 Layout ID: 408089 Ref # Page: 3 of 3 Date: 04-27-2020 Designer: Sales Rep: Mario DiCano

HARDWARE


QTY	TYPE	MODEL	LENGTH
2	Hardware	HGUS26-2	
3	Hardware	LJS26DS	
6	Hardware	LUS24	
3	Hardware	LUS26-2	

TOTAL NUMBER OF
ITEMS= 14

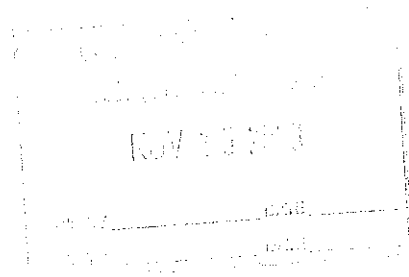

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 08:53:14 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-b3W11MNR57wh?ZdGV0o31kYG5mqx16Jz_4T3_zNEH3
Scale = 1:57.3

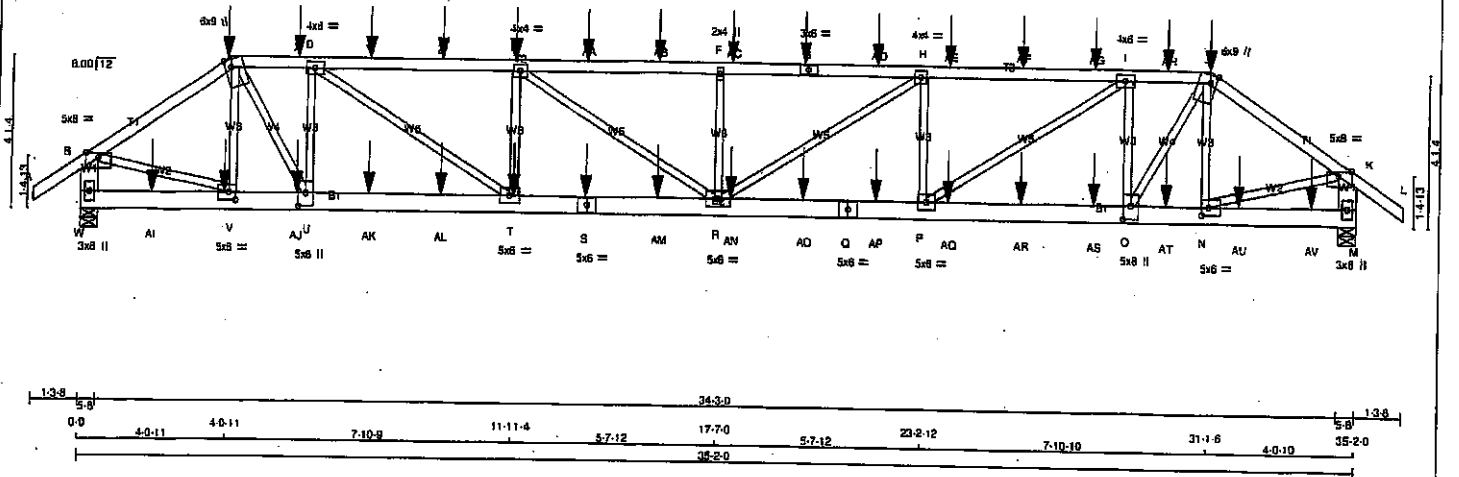

LUMBER	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES				
CHORDS				
A - C	2x4	DRY	No.2	SPF
C - G	2x4	DRY	No.2	SPF
G - J	2x4	DRY	No.2	SPF
J - L	2x4	DRY	No.2	SPF
W - B	2x6	DRY	No.2	SPF
M - K	2x6	DRY	No.2	SPF
W - S	2x6	DRY	No.2	SPF
S - Q	2x6	DRY	No.2	SPF
Q - M	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122'X3") SPIRAL NAILS		
A - C	12	SIDE(81.0)
C - G	12	SIDE(81.0)
G - J	12	SIDE(81.0)
J - L	12	SIDE(81.0)
W - B	2	TOP
M - K	2	TOP
BOTTOM CHORDS : (0.122'X3") SPIRAL NAILS		
W - S	12	SIDE(183.1)
S - Q	12	SIDE(0.0)
Q - M	12	SIDE(0.0)
WEBS : (0.122'X3") SPIRAL NAILS		
2x3	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	DOWN	IN-SX	IN-SX
W	3393	0	0	5-8
M	3342	0	0	5-8

UNFACTORED REACTIONS	1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
W	2397	1586 / 0
M	2363	1555 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) W, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.04 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LG1 MAX (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
MEMB.				MEMB.		
FR-TO				FR-TO		
A-B	0 / 35	-91.8	-91.8 0.07 (1)	10.00	V-C	-703 / 0
B-C	-4010 / 0	-91.8	-91.8 0.22 (1)	4.55	C-U	0 / 2685
C-X	-4696 / 0	-91.8	-91.8 0.29 (1)	4.16	U-D	-2159 / 0
X-D	-4696 / 0	-91.8	-91.8 0.29 (1)	4.16	O-I	-2187 / 0
D-Y	-3989 / 0	-91.8	-91.8 0.61 (1)	3.27	Q-J	0 / 2713
Y-Z	-6986 / 0	-91.8	-91.8 0.61 (1)	3.27	N-J	-691 / 0
Z-E	-6986 / 0	-91.8	-91.8 0.61 (1)	3.27	B-V	0 / 3425
E-AA	-7711 / 0	-91.8	-91.8 0.68 (1)	3.07	N-K	0 / 3359
AA-AB	-7711 / 0	-91.8	-91.8 0.68 (1)	3.07	D-T	0 / 2747
AB-F	-7711 / 0	-91.8	-91.8 0.68 (1)	3.07	P-H	-1354 / 0
F-AC	-7711 / 0	-91.8	-91.8 0.70 (1)	3.04	T-E	-1337 / 0
AC-G	-7711 / 0	-91.8	-91.8 0.70 (1)	3.04	R-H	0 / 893
G-AD	-7711 / 0	-91.8	-91.8 0.70 (1)	3.04	E-R	0 / 895
AD-H	-7711 / 0	-91.8	-91.8 0.70 (1)	3.04	R-F	-808 / 0
H-AE	-8966 / 0	-91.8	-91.8 0.63 (1)	3.24		
AE-AF	-8966 / 0	-91.8	-91.8 0.63 (1)	3.24		
AF-AG	-8966 / 0	-91.8	-91.8 0.63 (1)	3.24		
AG-I	-8966 / 0	-91.8	-91.8 0.63 (1)	3.24		
I-AH	-4647 / 0	-91.8	-91.8 0.30 (1)	4.16		
AH-J	-4647 / 0	-91.8	-91.8 0.30 (1)	4.16		
J-K	-3933 / 0	-91.8	-91.8 0.22 (1)	4.59		
K-L	0 / 35	-91.8	-91.8 0.07 (1)	10.00		
W-B	-3343 / 0	0.0	0.0 0.12 (1)	7.61		
M-K	-3265 / 0	0.0	0.0 0.12 (1)	7.68		

W-AI	0 / 0	-18.5	-18.5 0.04 (4)	10.00
A-V	0 / 0	-18.5	-18.5 0.04 (4)	10.00
V-AJ	0 / 3311	-18.5	-18.5 0.22 (1)	10.00
AJ-U	0 / 3311	-18.5	-18.5 0.22 (1)	10.00
U-AK	0 / 4697	-18.5	-18.5 0.35 (1)	10.00
AK-AL	0 / 4697	-18.5	-18.5 0.35 (1)	10.00
AL-T	0 / 4697	-18.5	-18.5 0.35 (1)	10.00
T-S	0 / 8989	-18.5	-18.5 0.52 (1)	10.00
S-AM	0 / 8989	-18.5	-18.5 0.52 (1)	10.00
AM-R	0 / 8989	-18.5	-18.5 0.52 (1)	10.00
R-AN	0 / 8986	-18.5	-18.5 0.52 (1)	10.00
AN-AO	0 / 8986	-18.5	-18.5 0.52 (1)	10.00
AO-Q	0 / 8986	-18.5	-18.5 0.52 (1)	10.00
Q-AP	0 / 8986	-18.5	-18.5 0.52 (1)	10.00
AP-P	0 / 8986	-18.5	-18.5 0.52 (1)	10.00
P-AQ	0 / 4648	-18.5	-18.5 0.35 (1)	10.00
AQ-AR	0 / 4648	-18.5	-18.5 0.35 (1)	10.00
AR-AS	0 / 4648	-18.5	-18.5 0.35 (1)	10.00

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.24")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/982 (0.44")

CSI: TC=0.70/1.00 (F+H:1), BC=0.52/1.00 (P-R:1), WB=0.42/1.00 (B-V:1), SS=0.19/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(LRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (G) INPUT = 0.90 ;
JSI METAL = 0.67 (S) INPUT = 1.00 ;

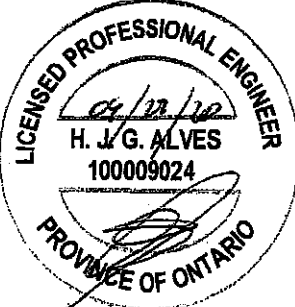

Structural component only
DWG# T-2006952

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408087	T1	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 06:53:14 2020 Page 2

ID=DMCubINVR6Ts(Foe31v6) zns11-b3Wf1MNR57wh?ZdGV0o31kYg5mqx6Jz 4T3 zNEh3

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW+m	MT20	6.0	9.0	Edge 2.00	
D	TMVW-t	MT20	4.0	6.0		
E	TMVW-i	MT20	4.0	4.0		
F	TMVW-w	MT20	2.0	4.0		
G	TS-i	MT20	3.0	6.0		
H	TMVW-t	MT20	4.0	4.0		
I	TMVW-t	MT20	4.0	6.0		
J	TTWW+m	MT20	6.0	9.0	Edge 2.00	
K	TMVW-p	MT20	5.0	8.0	Edge	
M	BMV1+p	MT20	3.0	6.0		
N	BMVW-t	MT20	5.0	6.0	2.50 2.25	
O	BMVW-t	MT20	5.0	6.0	4.25 2.50	
P	BMVW-t	MT20	5.0	6.0		
Q	BS-i	MT20	5.0	6.0		
R	BMVW-t	MT20	5.0	6.0		
S	BS-i	MT20	5.0	6.0		
T	BMVW-t	MT20	5.0	6.0		
U	BMVW-t	MT20	5.0	6.0	4.25 2.50	
V	BMVW-t	MT20	5.0	6.0	2.50 2.25	
W	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
AS-O	0/4648	-18.5	-18.5	0.35 (1)	10.00		
O-AT	0/3248	-18.5	-18.5	0.22 (1)	10.00		
AT-N	0/3248	-18.5	-18.5	0.22 (1)	10.00		
N-AU	0/0	-18.5	-18.5	0.03 (4)	10.00		
AU-AV	0/0	-18.5	-18.5	0.03 (4)	10.00		
AV-M	0/0	-18.5	-18.5	0.03 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-11	-49	-55		FRONT	VERT	DEAD		C1
C	4-0-11	-117	-117		BACK	VERT	TOTAL		C1
C	4-0-11	-254	-254		FRONT	VERT	SNOW		C1
E	11-11-4	-110	-110		BACK	VERT	TOTAL		C1
G	19-11-4	-110	-110		BACK	VERT	TOTAL		C1
J	31-1-8	-49	-55		FRONT	VERT	DEAD		C1
J	31-1-8	-254	-254		FRONT	VERT	SNOW		C1
S	13-11-4	-26	-26		BACK	VERT	TOTAL		C1
T	11-11-4	-26	-26		BACK	VERT	TOTAL		C1
V	3-11-4	-26	-26		BACK	VERT	TOTAL		C1
X	5-11-4	-110	-110		BACK	VERT	TOTAL		C1
Y	7-11-4	-110	-110		BACK	VERT	TOTAL		C1
Z	9-11-4	-110	-110		BACK	VERT	TOTAL		C1
AA	13-11-4	-110	-110		BACK	VERT	TOTAL		C1
AB	15-11-4	-110	-110		BACK	VERT	TOTAL		C1
AC	17-11-4	-110	-110		BACK	VERT	TOTAL		C1
AD	21-11-4	-110	-110		BACK	VERT	TOTAL		C1
AE	23-11-4	-110	-110		BACK	VERT	TOTAL		C1
AF	25-11-4	-110	-110		BACK	VERT	TOTAL		C1
AG	27-11-4	-110	-110		BACK	VERT	TOTAL		C1
AH	29-11-4	-110	-110		BACK	VERT	TOTAL		C1
AI	1-11-4	-26	-26		BACK	VERT	TOTAL		C1
AJ	5-11-4	-26	-26		BACK	VERT	TOTAL		C1
AK	7-11-4	-26	-26		BACK	VERT	TOTAL		C1
AL	9-11-4	-26	-26		BACK	VERT	TOTAL		C1
AM	15-11-4	-26	-26		BACK	VERT	TOTAL		C1
AN	17-11-4	-26	-26		BACK	VERT	TOTAL		C1
AO	19-11-4	-26	-26		BACK	VERT	TOTAL		C1
AP	21-11-4	-26	-26		BACK	VERT	TOTAL		C1
AQ	23-11-4	-26	-26		BACK	VERT	TOTAL		C1
AR	25-11-4	-26	-26		BACK	VERT	TOTAL		C1
AS	27-11-4	-26	-26		BACK	VERT	TOTAL		C1
AT	29-11-4	-26	-26		BACK	VERT	TOTAL		C1
AU	31-11-4	-26	-26		BACK	VERT	TOTAL		C1
AV	33-11-4	-26	-26		BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2006952

JOB NAME 408087	TRUSS NAME T12	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 08:53:15 2020 Page 1
 ID:DMCubNVR6TstFoe31v6i_zns11-3F3PwO3sQ2YcIS3UJaxFmCV7Eqi7SCeq0bRzNEh2
 Scale = 1:57.3

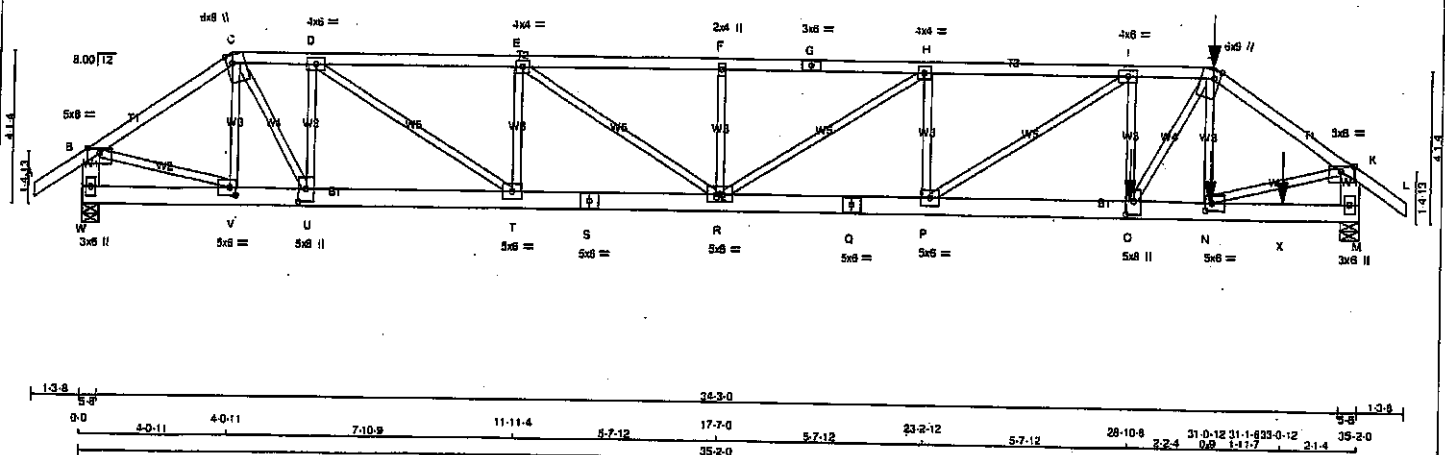

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS			
A - C	2x4	DRY	No.2
C - G	2x4	DRY	No.2
G - L	2x4	DRY	No.2
J - M	2x4	DRY	No.2
W - B	2x6	DRY	No.2
M - K	2x6	DRY	No.2
W - S	2x6	DRY	No.2
S - Q	2x6	DRY	No.2
Q - M	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122'X3') SPIRAL NAILS		
A-C	12	TOP
C-G	12	TOP
G-J	12	SIDE(61.0)
J-L	12	SIDE(61.0)
W-B	12	TOP
M-K	12	TOP
BOTTOM CHORDS : (0.122'X3') SPIRAL NAILS		
W-S	12	TOP
S-Q	12	TOP
Q-M	12	SIDE(183.1)
WEBS : (0.122'X3') SPIRAL NAILS		
2x3	6	SIDE(427.3)
I-O	4	
D-U	4	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
W	2536	0	2536	0	5-8
M	4405	0	4405	0	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
W	1791	1188 / 0	0 / 0	0 / 0	0 / 0	603 / 0	0 / 0
M	3114	2053 / 0	0 / 0	0 / 0	0 / 0	1051 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) W, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.38 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
A-B	0 / 35	-91.8	-91.8 0.07 (1)	V-C	-516 / 0
B-C	-2897 / 0	-91.8	-91.8 0.18 (1)	C-U	0 / 2211
C-D	-3532 / 0	-91.8	-91.8 0.18 (1)	U-D	-1810 / 0
D-E	-5663 / 0	-91.8	-91.8 0.29 (1)	D-I	-867 / 0
E-F	-6822 / 0	-91.8	-91.8 0.47 (1)	C-J	0 / 3695
F-G	-6822 / 0	-91.8	-91.8 0.48 (1)	N-J	-872 / 0
G-H	-6822 / 0	-91.8	-91.8 0.48 (1)	B-V	0 / 2475
H-I	-7096 / 0	-91.8	-91.8 0.50 (1)	N-K	0 / 4576
I-J	-6332 / 0	-91.8	-91.8 0.25 (1)	P-I	0 / 916
J-K	-5358 / 0	-91.8	-91.8 0.28 (1)	D-T	0 / 2553
K-L	0 / 35	-91.8	-91.8 0.07 (1)	P-H	-363 / 0
W-B	-2502 / 0	0.0	0.0 0.09 (1)	T-E	-1302 / 0
M-K	-4381 / 0	0.0	0.0 0.18 (1)	R-H	-328 / 0
W-V	0 / 0	-18.5	-18.5 0.02 (4)	E-R	0 / 1389
V-U	0 / 2392	-18.5	-18.5 0.16 (1)	R-F	-503 / 0
U-T	0 / 3533	-18.5	-18.5 0.26 (1)		
T-S	0 / 5663	-18.5	-18.5 0.42 (1)		
S-R	0 / 5663	-18.5	-18.5 0.42 (1)		
R-Q	0 / 7096	-18.5	-18.5 0.51 (1)		
Q-P	0 / 7096	-18.5	-18.5 0.51 (1)		
P-O	0 / 6332	-18.5	-18.5 0.48 (1)		
O-N	0 / 4426	-18.5	-18.5 0.35 (1)		
N-X	0 / 0	-18.5	-18.5 0.03 (4)		
X-M	0 / 0	-18.5	-18.5 0.03 (4)		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
J	31-1-6	-49	-55	---	FRONT	VERT	DEAD	---	C1
J	31-1-6	-118	-118	---	FRONT	VERT	TOTAL	---	C1
J	31-1-6	-254	-254	---	FRONT	VERT	SNOW	---	C1
N	31-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
O	28-10-8	-2340	-2340	---	FRONT	VERT	TOTAL	---	C1
X	33-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
 GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
 LOADS WERE DERIVED FROM USER INPUT
 NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 34.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
 CALCULATED VERT. DEFL.(LL) = L/999 (0.21)
 ALLOWABLE DEFL.(TL) = L/360 (1.17)
 CALCULATED VERT. DEFL.(TL) = L/999 (0.39)

CSI: TC=0.50/1.00 (H-t); BC=0.51/1.00 (P-R);
 WB=0.57/1.00 (K-N); SS=0.12/1.00 (H-t)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
 MAX MIN MAX MIN MAX MIN
 MT20 616 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (N) INPUT = 0.90
 JSI METAL= 0.65 (S) INPUT = 1.00



Structural component only
 DWG# T-2006953 1/2

CONTINUED ON PAGE 2

JOB NAME 408087	TRUSS NAME T1Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 08:53:15 2020 Page 2
ID:DMCubINVR6TstFoe31v6l zns1l-3F3PwIC3sQ2YciCS3JMaxFmCV7EqI7SCeo0bRznNEh2


PLATES (Table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW+m	MT20	6.0	9.0	Edge 2.00	
D	TMWW-t	MT20	4.0	6.0		
E	TMWW-t	MT20	4.0	4.0		
F	TMW+w	MT20	2.0	4.0		
G	TS-t	MT20	3.0	6.0		
H	TMWW-t	MT20	4.0	4.0		
I	TMWW-t	MT20	4.0	6.0		
J	TTWW+m	MT20	6.0	9.0	Edge 2.00	
K	TMVW-p	MT20	5.0	8.0	Edge	
M	BMV1+p	MT20	3.0	6.0		
N	BMWW-t	MT20	5.0	6.0	2.50 2.00	
O	BMWW+t	MT20	5.0	8.0	4.25 2.50	
P	BMWW-t	MT20	5.0	6.0		
Q	BS-t	MT20	5.0	6.0		
R	BMWWW-t	MT20	5.0	8.0		
S	BS-t	MT20	5.0	6.0		
T	BMWW-t	MT20	5.0	6.0		
U	BMWW+t	MT20	5.0	8.0	4.25 2.50	
V	BMWW-t	MT20	5.0	6.0	2.50 2.00	
W	BMV1+p	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

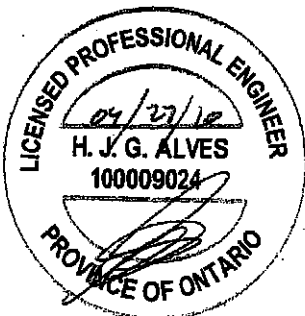

Structural component only
DWG# T-2006953 3/2

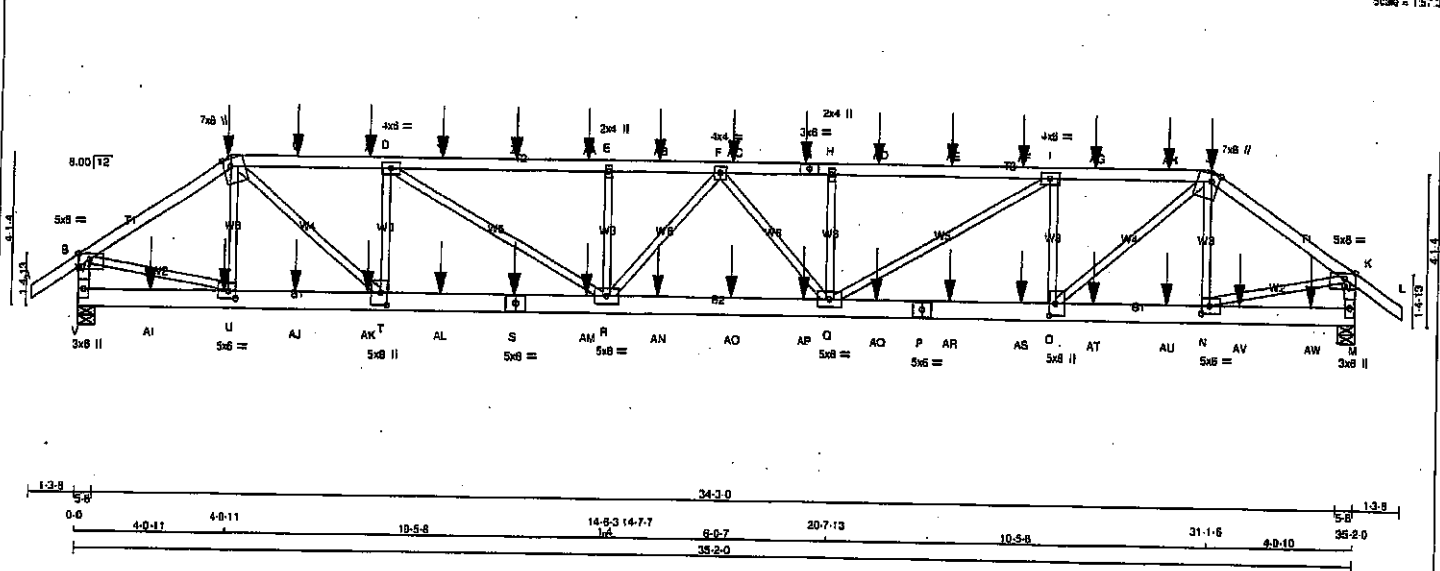

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - G	2x4	DRY	No.2	SPF
G - J	2x4	DRY	No.2	SPF
J - L	2x4	DRY	No.2	SPF
V - B	2x4	DRY	No.2	SPF
M - K	2x4	DRY	No.2	SPF
V - S	2x4	DRY	No.2	SPF
S - P	2x4	DRY	No.2	SPF
P - M	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C	12	SIDE(61.0)
C-G	12	SIDE(61.0)
G-J	12	SIDE(61.0)
J-L	12	SIDE(61.0)
V-B	12	TOP
M-K	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
V-S	12	SIDE(183.1)
S-P	12	SIDE(0.0)
P-M	12	SIDE(0.0)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	3393	0	5-8
V HCRZ	3342	0	5-8
M UPLIFT	3342	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	2387
V SNOW	1585 / 0
M LIVE	2363
	1555 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.05 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO	
A-B	0 / 35	-91.8	-91.8 0.07 (1)	U-C	-658 / 0
B-C	-4013 / 0	-91.8	-91.8 0.22 (1)	C-T	0 / 3210
C-W	-5748 / 0	-91.8	-91.8 0.48 (1)	T-D	-1922 / 0
W-X	-5748 / 0	-91.8	-91.8 0.48 (1)	D-Q	-1945 / 0
X-D	-5748 / 0	-91.8	-91.8 0.48 (1)	Q-J	0 / 3243
D-Y	-7489 / 0	-91.8	-91.8 0.78 (1)	J-N	-839 / 0
Y-Z	-7489 / 0	-91.8	-91.8 0.78 (1)	N-K	0 / 3361
Z-AA	-7489 / 0	-91.8	-91.8 0.78 (1)	K-I	0 / 2078
AA-E	-7489 / 0	-91.8	-91.8 0.78 (1)	I-R	0 / 2048
E-AB	-7489 / 0	-91.8	-91.8 0.78 (1)	R-H	-770 / 0
AB-F	-7489 / 0	-91.8	-91.8 0.78 (1)	H-E	-769 / 0
F-AC	-7488 / 0	-91.8	-91.8 0.48 (1)	E-F	-141 / 0
AC-G	-7486 / 0	-91.8	-91.8 0.48 (1)	F-Q	-161 / 0
G-H	-7486 / 0	-91.8	-91.8 0.48 (1)		
H-AD	-7486 / 0	-91.8	-91.8 0.77 (1)		
AD-AE	-7486 / 0	-91.8	-91.8 0.77 (1)		
AE-AF	-7486 / 0	-91.8	-91.8 0.77 (1)		
AF-I	-7486 / 0	-91.8	-91.8 0.77 (1)		
I-AG	-5710 / 0	-91.8	-91.8 0.50 (1)		
AG-AH	-5710 / 0	-91.8	-91.8 0.50 (1)		
AH-J	-5710 / 0	-91.8	-91.8 0.50 (1)		
J-K	-3935 / 0	-91.8	-91.8 0.22 (1)		
K-L	0 / 35	-91.8	-91.8 0.07 (1)		
V-B	-3345 / 0	0.0	0.0 0.19 (1)		
M-K	-3288 / 0	0.0	0.0 0.18 (1)		
V-AI	0 / 0	-18.5	-18.5 0.03 (4)		
AI-U	0 / 0	-18.5	-18.5 0.03 (4)		
U-AJ	0 / 3315	-18.5	-18.5 0.24 (1)		
AJ-AK	0 / 3315	-18.5	-18.5 0.24 (1)		
AK-T	0 / 3315	-18.5	-18.5 0.24 (1)		
T-AL	0 / 5749	-18.5	-18.5 0.44 (1)		
AL-S	0 / 5749	-18.5	-18.5 0.44 (1)		
S-AM	0 / 5749	-18.5	-18.5 0.44 (1)		
AM-R	0 / 5749	-18.5	-18.5 0.44 (1)		
R-AN	0 / 7589	-18.5	-18.5 0.57 (1)		
AN-AO	0 / 7589	-18.5	-18.5 0.57 (1)		
AO-AP	0 / 7589	-18.5	-18.5 0.57 (1)		
AP-Q	0 / 7589	-18.5	-18.5 0.57 (1)		
Q-AQ	0 / 5710	-18.5	-18.5 0.43 (1)		
AQ-P	0 / 5710	-18.5	-18.5 0.43 (1)		
P-AR	0 / 5710	-18.5	-18.5 0.43 (1)		
AR-AS	0 / 5710	-18.5	-18.5 0.43 (1)		

TOTAL WEIGHT = 2 X 180 = 321 LB

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***

GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.

LOADS WERE DERIVED FROM USER INPUT

NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA C88-09, CSA C88-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")

CALCULATED VERT. DEFL.(LL) = L/599 (0.23")

ALLOWABLE DEFL.(TL) = L/360 (1.17")

CALCULATED VERT. DEFL.(TL) = L/964 (0.44")

CSI: TC=0.77/1.00 (H-I:1), BC=0.57/1.00 (Q-R:1), WS=0.42/1.00 (B-U:1), SSI=0.20/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1687 788 1987 1686

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.73 (G) INPUT = 0.90

JSI METAL = 0.57 (S) INPUT = 1.00



Structural component only
DWG# T-2006982 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408088	T100	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 3.310 5 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:03:38 2020 Page 2
ID:DMCubINVR6TstFoe31v8l zns11-K6Dwckws8rY8sSKB33 OKJY9lek78Wa9T3EUvqzNEXJ

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TTWW-m	MT20	7.0	8.0	Edge	2.50
D	TMVW-l	MT20	4.0	6.0		
E	TMVW-w	MT20	2.0	4.0		
F	TMVW-l	MT20	4.0	4.0		
G	TS-l	MT20	3.0	6.0		
H	TMVW-w	MT20	2.0	4.0		
I	TMVW-l	MT20	4.0	6.0		
J	TTWW-m	MT20	7.0	8.0	Edge	2.50
K	TMVW-p	MT20	5.0	8.0	Edge	3.50
M	BMV1-p	MT20	3.0	6.0		
N	BMVW-l	MT20	5.0	8.0	2.50	2.50
O	BMVW-l	MT20	5.0	8.0	4.00	2.00
P	BS-l	MT20	5.0	6.0		
Q	BMVW-l	MT20	5.0	8.0		
R	BMVW-l	MT20	5.0	8.0		
S	BS-l	MT20	5.0	6.0		
T	BMVW-l	MT20	5.0	8.0	4.00	2.00
U	BMVW-l	MT20	5.0	8.0	2.50	2.50
V	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)


CHORDS				WEBS			
MAX. FACTORED		FACTORED		FACTORED		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 CS1 (L/C)	MAX. UNIFAC LENGTH	MEMB.	FORCE (LBS)	MAX CS1 (L/C)
FR-TO		FROM	TO		FR-TO		
AS-O	0.5710	-18.5	-18.5	0.43 (1)			
O-AT	0.3251	-18.5	-18.5	0.23 (1)			
AT-AU	0.3251	-18.5	-18.5	0.23 (1)			
AU-N	0.3251	-18.5	-18.5	0.23 (1)			
N-AV	0.0	-18.5	-18.5	0.03 (4)			
AV-AW	0.0	-18.5	-18.5	0.03 (4)			
AW-M	0.0	-18.5	-18.5	0.03 (4)			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-11	-49	-55	FRONT	VERT	DEAD	---	C1
C	4-0-11	-117	-117	BACK	VERT	TOTAL	---	C1
C	4-0-11	-254	-254	FRONT	VERT	SNOW	---	C1
G	19-11-4	-110	-110	BACK	VERT	TOTAL	---	C1
J	31-1-6	-49	-55	FRONT	VERT	DEAD	---	C1
J	31-1-6	-254	-254	FRONT	VERT	SNOW	---	C1
S	11-11-4	-28	-28	BACK	VERT	TOTAL	---	C1
U	3-11-4	-26	-26	BACK	VERT	TOTAL	---	C1
W	5-11-4	-110	-110	BACK	VERT	TOTAL	---	C1
X	7-11-4	-110	-110	BACK	VERT	TOTAL	---	C1
Y	9-11-4	-110	-110	BACK	VERT	TOTAL	---	C1
Z	11-11-4	-110	-110	BACK	VERT	TOTAL	---	C1
AA	13-11-4	-110	-110	BACK	VERT	TOTAL	---	C1
AB	15-11-4	-110	-110	BACK	VERT	TOTAL	---	C1
AC	17-11-4	-110	-110	BACK	VERT	TOTAL	---	C1
AD	21-11-4	-110	-110	BACK	VERT	TOTAL	---	C1
AE	23-11-4	-110	-110	BACK	VERT	TOTAL	---	C1
AF	25-11-4	-110	-110	BACK	VERT	TOTAL	---	C1
AG	27-11-4	-110	-110	BACK	VERT	TOTAL	---	C1
AH	29-11-4	-110	-110	BACK	VERT	TOTAL	---	C1
AI	1-11-4	-26	-26	BACK	VERT	TOTAL	---	C1
AJ	5-11-4	-26	-26	BACK	VERT	TOTAL	---	C1
AK	7-11-4	-26	-26	BACK	VERT	TOTAL	---	C1
AL	9-11-4	-26	-26	BACK	VERT	TOTAL	---	C1
AM	13-11-4	-26	-26	BACK	VERT	TOTAL	---	C1
AN	15-11-4	-26	-26	BACK	VERT	TOTAL	---	C1
AO	17-11-4	-26	-26	BACK	VERT	TOTAL	---	C1
AP	19-11-4	-26	-26	BACK	VERT	TOTAL	---	C1
AQ	21-11-4	-26	-26	BACK	VERT	TOTAL	---	C1
AR	23-11-4	-26	-26	BACK	VERT	TOTAL	---	C1
AS	25-11-4	-26	-26	BACK	VERT	TOTAL	---	C1
AT	27-11-4	-26	-26	BACK	VERT	TOTAL	---	C1
AU	29-11-4	-26	-26	BACK	VERT	TOTAL	---	C1
AV	31-11-4	-26	-26	BACK	VERT	TOTAL	---	C1
AW	33-11-4	-26	-26	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

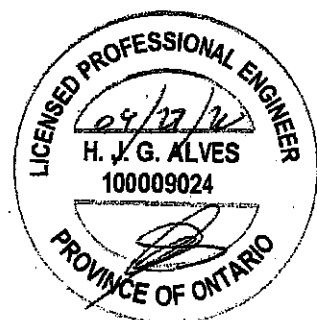

Structural component only
DWG# T-2006982

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408088	T100Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:03:39 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_znst1-0nlt3Xv9g?UcvOcnVdsX5MC14NwLh_1UGzNEXI
13.8 0.0 4.0 11 4.0 11 10.5 3 14.5 3 3.0 13 17.7 0 3.0 13 20.7 13 4.0 15 27.5 12 28.0 12 31.1 4 35.2 0 38.5 8 1.3 3
Scale = 1:57.2

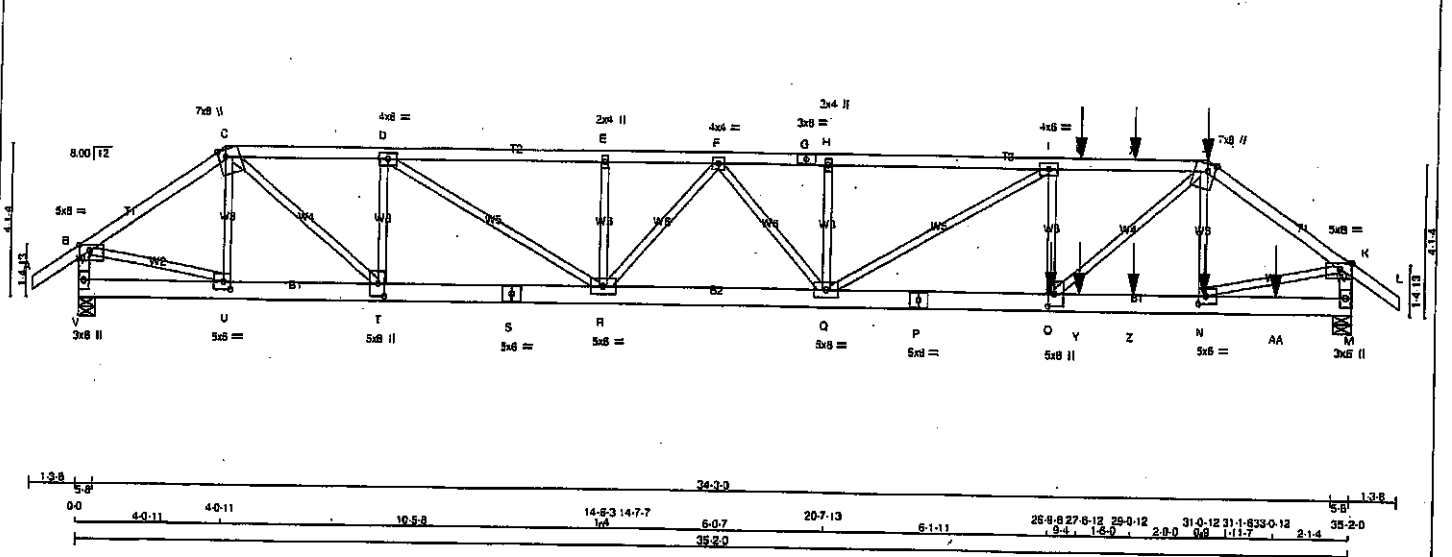

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR.
A - C 2x4 DRY No.2 SPF
C - G 2x4 DRY No.2 SPF
G - J 2x4 DRY No.2 SPF
J - L 2x4 DRY No.2 SPF
V - B 2x4 DRY No.2 SPF
M - K 2x4 DRY No.2 SPF
V - S 2x6 DRY No.2 SPF
S - P 2x6 DRY No.2 SPF
P - M 2x6 DRY No.2 SPF
ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DESIGN CRITERIA
*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

BEARINGS
FACTORED MAXIMUM FACTORED INPUT RECD
GROSS REACTION GROSS REACTION BRG BRG
JT VERT 2660 0 2660 0 5-8 5-8
V 4269 0 4269 0 5-8 5-8
M 4269 0 4269 0 5-8 5-8

UNFACTORED REACTIONS
1ST LOASE MAX/MIN COMPONENT REACTIONS
JT COMBINED SNOW LIVE PERM LIVE WIND DEAD SOIL
V 1679 1243 / 0 0 / 0 0 / 0 636 / 0 0 / 0
M 3018 1986 / 0 0 / 0 0 / 0 1033 / 0 0 / 0

BEARING MATERIAL TO BE SPFF NO.2 OR BETTER AT JOINT(S) V, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.14 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS #ROWS SURFACE SPACING (IN) LOAD(PLF)

TOP CHORDS : (0.122"x3") SPIRAL NAILS

CHORDS
MAX. FACTORED FACTORED WEBS
MEMB. FORCE VERT. LOAD LC1 MAX UNBRAC MEMB. MAX. FACTORED
(LBS) (PLF) CSI (LC) LENGTH FR-TO (LBS) CSI (LC)

FR-TO FROM TO

MEMB. FORCE VERT. LOAD LC1 MAX UNBRAC MEMB. MAX. FACTORED

(LBS) (PLF) CSI (LC) LENGTH FR-TO (LBS) CSI (LC)

FR-TO FROM TO

MEMB. FORCE VERT. LOAD LC1 MAX UNBRAC MEMB. MAX. FACTORED

(LBS) (PLF) CSI (LC) LENGTH FR-TO (LBS) CSI (LC)

FR-TO FROM TO

MEMB. FORCE VERT. LOAD LC1 MAX UNBRAC MEMB. MAX. FACTORED

(LBS) (PLF) CSI (LC) LENGTH FR-TO (LBS) CSI (LC)

FR-TO FROM TO

MEMB. FORCE VERT. LOAD LC1 MAX UNBRAC MEMB. MAX. FACTORED

(LBS) (PLF) CSI (LC) LENGTH FR-TO (LBS) CSI (LC)

FR-TO FROM TO

MEMB. FORCE VERT. LOAD LC1 MAX UNBRAC MEMB. MAX. FACTORED

(LBS) (PLF) CSI (LC) LENGTH FR-TO (LBS) CSI (LC)


FR-TO FROM TO

MEMB. FORCE VERT. LOAD LC1 MAX UNBRAC MEMB. MAX. FACTORED

(LBS) (PLF) CSI (LC) LENGTH FR-TO (LBS) CSI (LC)

FR-TO FROM TO

MEMB. FORCE VERT. LOAD LC1 MAX UNBRAC MEMB. MAX. FACTORED

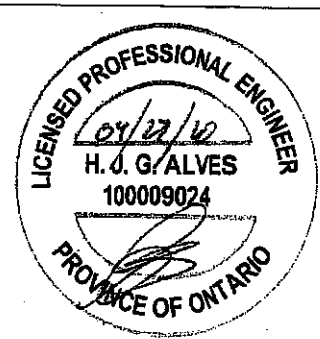

Structural component only
DWG# T-2006983 1/2

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEF.(LL) = U360 (1.17")

CALCULATED VERT. DEF.(LL) = L/999 (0.23")

ALLOWABLE DEF.(TL) = U360 (1.17")

CALCULATED VERT. DEF.(TL) = L/992 (0.43")

CSI: TC=0.86/1.00 (H-I), BC=0.57/1.00 (O-Q), LB=0.55/1.00 (K-N), SS=0.18/1.00 (J-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1657 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (B) INPUT = 0.90

JSI METAL= 0.72 (P) INPUT = 1.00

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408088	T100Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 09:03:39 2020 Page 2
ID:DMCubINVR6TstFoe31v6I zns1I-olnIK3xUv9a?UcvOcnVdsX5MC14NwUjh 1UGzNEXI

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TTWW-m	MT20	7.0	8.0	Edge	2.50
D	TMWW-t	MT20	4.0	5.0		
E	TMW-w	MT20	2.0	4.0		
F	TMWW-t	MT20	4.0	4.0		
G	TS-t	MT20	3.0	5.0		
H	TMW-w	MT20	2.0	4.0		
I	TMWW-t	MT20	4.8	5.0		
J	TTWW-m	MT20	7.0	8.0	Edge	2.50
K	TMVW-p	MT20	5.0	8.0	Edge	3.50
M	BMV1-p	MT20	3.0	6.0		
N	BMWW-t	MT20	5.0	8.0	2.50	2.50
O	BMWW-t	MT20	5.0	8.0	4.00	2.00
P	BS-t	MT20	5.0	6.0		
Q	BMWWW-t	MT20	5.0	8.0		
R	BMWWW-t	MT20	5.0	8.0		
S	BS-t	MT20	5.0	6.0		
T	BMWW-t	MT20	5.0	8.0	4.00	2.00
U	BMWW-t	MT20	5.0	8.0	2.50	2.50
V	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2006983 2/2

JOB NAME 408087	TRUSS NAME T2	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 08:53:16 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns11-XSdn72OtdkAPesmdRqX69orNvQSPCCcRIZZ7bNEh1
35 2.0 36 3.8
Scale = 1/32"

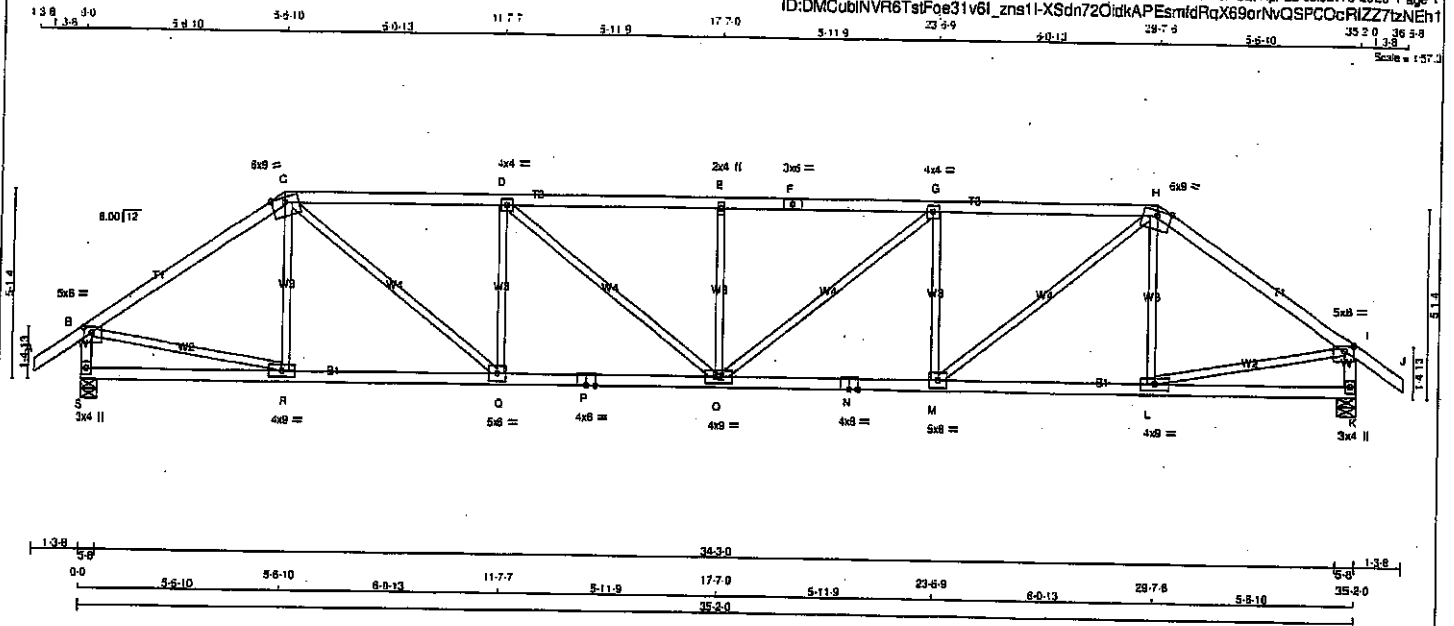

LUMBER	N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS				
A - C	2x4	DRY	No.2	SPF
C - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF
S - B	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
S - P	2x4	DRY	No.2	SPF
P - N	2x4	DRY	No.2	SPF
N - K	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT
SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

PLATE TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	6.0	1.75	2.75
C TTWW-m	MT20	6.0	9.0	Edge	
D TMVW-t	MT20	4.0	4.0		
E TMVW-w	MT20	2.0	4.0		
F TS-t	MT20	3.0	6.0		
G TMVW-t	MT20	4.0	4.0		
H TTWW-m	MT20	6.0	9.0	Edge	
I TMVW-p	MT20	5.0	6.0	1.75	2.75
K BMV1-p	MT20	3.0	4.0		
L BMVW-t	MT20	4.0	9.0		
M BMVW-t	MT20	5.0	6.0		
N BS-t	MT20	4.0	6.0		
O BMVW-t	MT20	4.0	9.0		
P BS-t	MT20	4.0	6.0		
Q BMVW-t	MT20	5.0	6.0		
R BMVW-t	MT20	4.0	9.0		
S BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS									
FACTORED			MAXIMUM FACTORED			INPUT	REQD		
GROSS REACTION			GROSS REACTION			BRG	BRG		
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX		IN-SX	
S	2085	0	2085	0	0	5-8		5-8	
K	2085	0	2085	0	0	5-8		5-8	

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
K	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	MAX. CSI (LC)
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	R-C	-243 / 10	0.03 (1)
B-C	-2297 / 0	-91.8	-91.8 0.70 (1)	3.78	C-Q	0 / 1670	0.38 (1)
C-D	-3214 / 0	-91.8	-91.8 0.80 (1)	3.18	Q-D	-929 / 0	0.36 (1)
D-E	-3595 / 0	-91.8	-91.8 0.86 (1)	2.97	D-O	0 / 490	0.11 (1)
E-F	-3595 / 0	-91.8	-91.8 0.86 (1)	2.97	O-E	-505 / 0	0.19 (1)
F-G	-3595 / 0	-91.8	-91.8 0.86 (1)	2.97	G-H	0 / 490	0.11 (1)
G-H	-3214 / 0	-91.8	-91.8 0.80 (1)	3.18	M-G	-929 / 0	0.36 (1)
H-I	-2297 / 0	-91.8	-91.8 0.70 (1)	3.78	M-H	0 / 1670	0.38 (1)
I-J	0 / 35	-91.8	-91.8 0.12 (1)	10.00	L-H	-243 / 10	0.03 (1)
S-B	-2023 / 0	0.0	0.0 0.21 (1)	5.94	B-R	0 / 1943	0.44 (1)
K-I	-2023 / 0	0.0	0.0 0.21 (1)	5.94	L-I	0 / 1943	0.44 (1)
S-R	0 / 0	-18.5	-18.5 0.15 (4)	10.00			
R-Q	0 / 1904	-18.5	-18.5 0.39 (1)	10.00			
Q-P	0 / 3214	-18.5	-18.5 0.58 (1)	10.00			
P-O	0 / 3214	-18.5	-18.5 0.58 (1)	10.00			
O-N	0 / 3214	-18.5	-18.5 0.58 (1)	10.00			
N-M	0 / 3214	-18.5	-18.5 0.58 (1)	10.00			
M-L	0 / 1904	-18.5	-18.5 0.39 (1)	10.00			
L-K	0 / 0	-18.5	-18.5 0.15 (4)	10.00			

TOTAL WEIGHT = 2 X 140 = 280 LB

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CSL TC=0.88/1.00 (E-G:1) . BC=0.58/1.00 (O-Q:1) .
WB=0.44/1.00 (B-R:1) . SS=0.26/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 789 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (B) (INPUT = 0.90)
JSI METAL= 0.74 (P) (INPUT = 1.00)

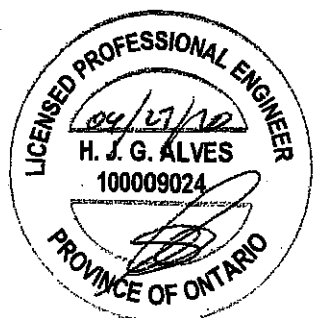


Structural component only
DWG# T-2006954

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408087	T3	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310.5 Oct 29 2019 MTX Industries, Inc. Sat Apr 25 08:53:16 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-XSdn72OidkAPEsmtdRqX69ow0vSsP37cRIZZ7tZNEh1
Scale = 1:57.37

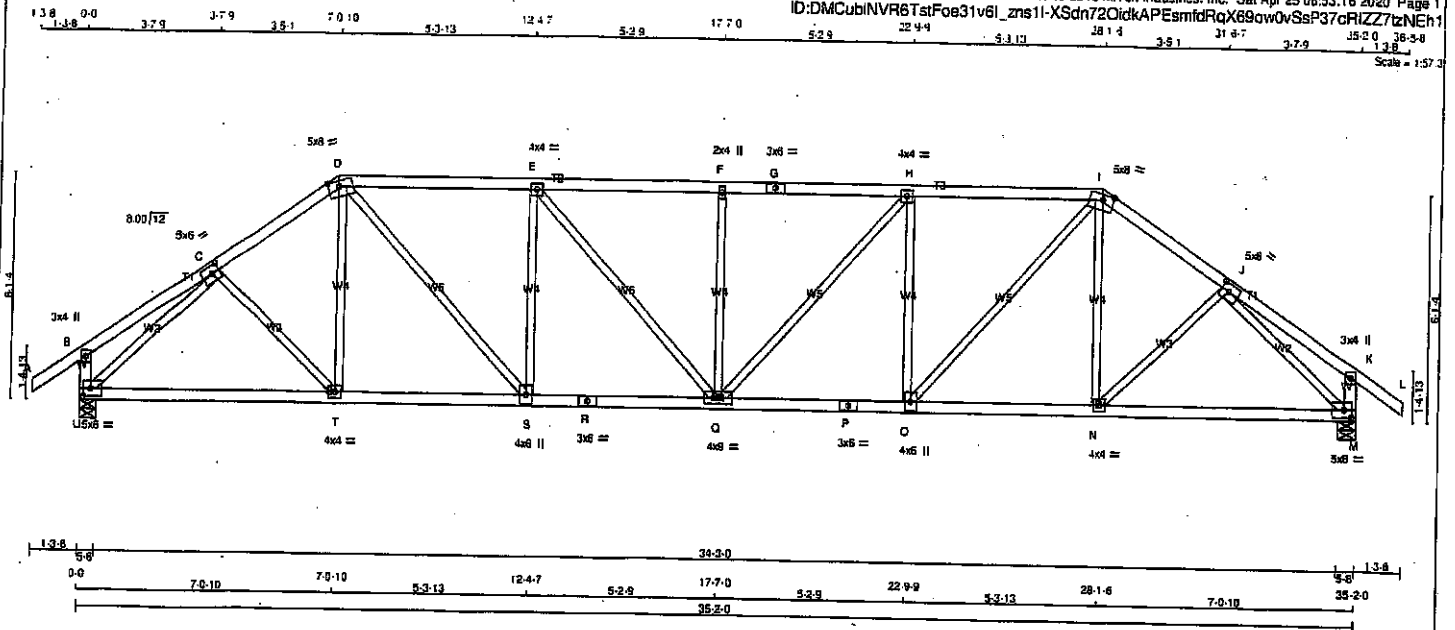

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
U - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMWV-t	MT20	5.0	8.0	2.50	2.50
D TTWW-m	MT20	5.0	8.0	1.75	3.50
E TMWV-t	MT20	4.0	4.0		
F TMWV-w	MT20	2.0	4.0		
G TS-t	MT20	3.0	6.0		
H TMWV-t	MT20	4.0	4.0		
I TTWW-m	MT20	5.0	8.0	1.75	3.50
J TMWV-t	MT20	5.0	6.0	2.50	2.50
K TMV+p	MT20	3.0	4.0		
M BMWV-t	MT20	5.0	8.0	2.50	2.25
N BMWV-t	MT20	4.0	4.0		
O BMWV-t	MT20	4.0	6.0		
P BS-t	MT20	3.0	6.0		
Q BMWV-t	MT20	4.0	9.0		
R BS-t	MT20	3.0	6.0		
S BMWV-t	MT20	4.0	6.0		
T BMWV-t	MT20	4.0	4.0		
U BMWV-t	MT20	5.0	8.0	2.50	2.25

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED	MAXIMUM FACTORED	INPUT	REQD	
	GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
U	2085	0	2085	0	0
M	2085	0	2085	0	0

UNFACTORED REACTIONS

1ST LCASE MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
U	1458	970 / 0	0 / 0	0 / 0	488 / 0
M	1458	970 / 0	0 / 0	0 / 0	488 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.53 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FORCE (LBS)	VERT. LOAD LC1	MAX. FACTORED	MEMB.	MAX. FACTORED	FORCE (LBS)
FR-TO					FR-TO		
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	C-T	0 / 135	0.03 (4)
B-C	0 / 18	-91.8	-91.8 0.16 (1)	10.00	T-D	0 / 90	0.03 (4)
C-D	-2306 / 0	-91.8	-91.8 0.23 (1)	4.31	D-S	0 / 1218	0.27 (1)
D-E	-2724 / 0	-91.8	-91.8 0.54 (1)	3.99	S-E	-814 / 0	0.48 (1)
E-F	-2957 / 0	-91.8	-91.8 0.56 (1)	3.53	E-Q	0 / 363	0.08 (1)
F-G	-2967 / 0	-91.8	-91.8 0.56 (1)	3.53	Q-F	-440 / 0	0.26 (1)
G-H	-2967 / 0	-91.8	-91.8 0.56 (1)	3.53	H-Q	0 / 363	0.08 (1)
H-I	-2724 / 0	-91.8	-91.8 0.54 (1)	4.31	Q-H	-814 / 0	0.48 (1)
I-J	-2306 / 0	-91.8	-91.8 0.23 (1)	4.31	O-I	0 / 1218	0.27 (1)
J-K	0 / 18	-91.8	-91.8 0.16 (1)	10.00	N-I	0 / 90	0.03 (4)
K-L	0 / 35	-91.8	-91.8 0.12 (1)	10.00	N-J	0 / 135	0.03 (4)
U-B	-255 / 0	0.0	0.0 0.03 (1)	7.81	U-C	-2515 / 0	0.97 (1)
M-K	-255 / 0	0.0	0.0 0.03 (1)	7.81	J-M	-2515 / 0	0.97 (1)
U-T	0 / 1802	-18.5	-18.5 0.40 (1)	10.00			
T-S	0 / 1901	-18.5	-18.5 0.41 (1)	10.00			
S-R	0 / 2724	-18.5	-18.5 0.49 (1)	10.00			
R-Q	0 / 2724	-18.5	-18.5 0.49 (1)	10.00			
Q-P	0 / 2724	-18.5	-18.5 0.49 (1)	10.00			
P-O	0 / 2724	-18.5	-18.5 0.49 (1)	10.00			
O-N	0 / 1901	-18.5	-18.5 0.41 (1)	10.00			
N-M	0 / 1802	-18.5	-18.5 0.40 (1)	10.00			

TOTAL WEIGHT = 2 X 151 = 303 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 085-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (1.17)
CALCULATED VERT. DEFL.(LL) = L/999 (0.16")
ALLOWABLE DEFL.(TL) = L/380 (1.17)
CALCULATED VERT. DEFL.(TL) = L/999 (0.29")
CSI: TC=0.58/1.00 (E-F:1), BC=0.49/1.00 (Q-S:1),
WB=0.97/1.00 (C-U:1), SS=0.23/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (U) (INPUT = 0.90)
JSI METAL= 0.84 (P) (INPUT = 1.00)




Structural component only
DWG# T-2006955

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408087	T4	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 08:53:17 2020 Page 1
ID:DMCubINVR6TstFoa31v6l_zns11-0eB9KOPKO2IGs0LrA8LmfMK3SloP8dKllyJ7fJzNEh0
35-2 0 36-5 8 1 2 8
Scale = 1:57.3

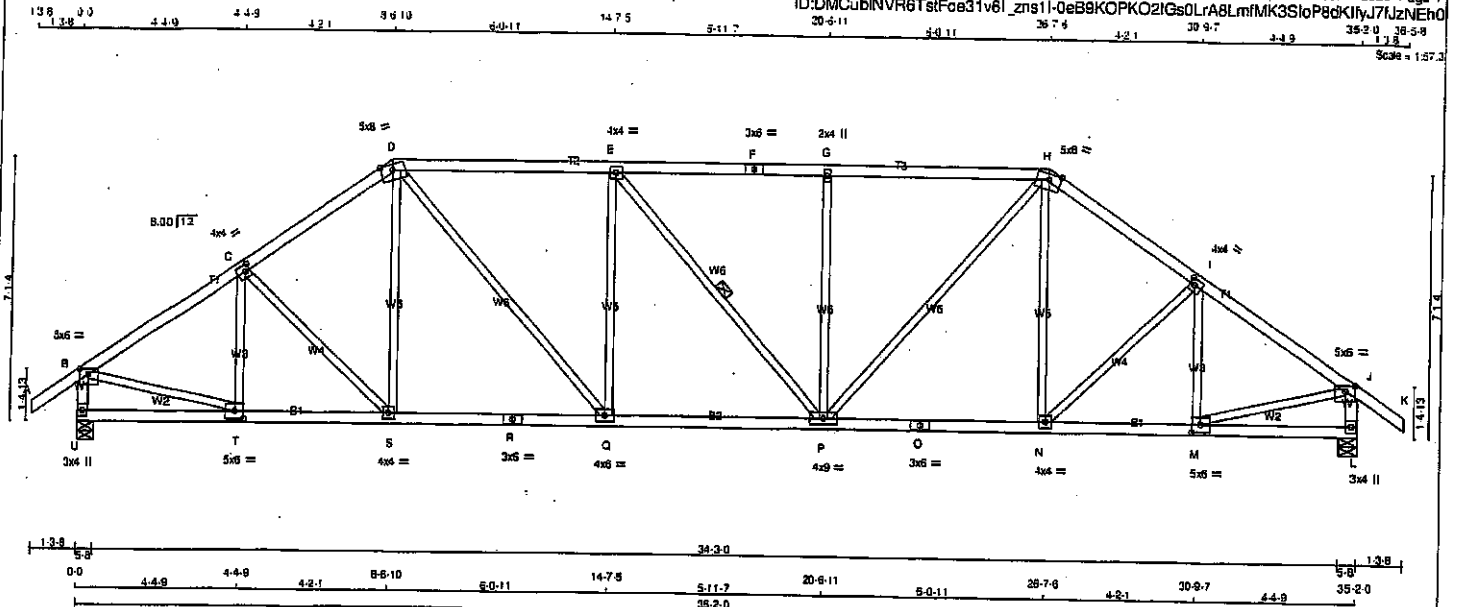

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				TOTAL WEIGHT = 2 X 155 = 309 lb			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	DESIGN CRITERIA	
A - D	2x4	DRY	No.2	SPF	VERT	2065	2065	0	5-8	TOP CH. LL = 25.8 PSF	
D - F	2x4	DRY	No.2	SPF	HORZ	0	0	0	5-8	DL = 8.0 PSF	
F - H	2x4	DRY	No.2	SPF	DOWN	2065	2065	0	5-8	LL = 0.0 PSF	
H - K	2x4	DRY	No.2	SPF	UPLIFT	0	0	0	5-8	DL = 7.4 PSF	
U - B	2x4	DRY	No.2	SPF						TOTAL LOAD = 39.0 PSF	
L - J	2x4	DRY	No.2	SPF						SPACING = 24.0 IN. C/C	
U - R	2x4	DRY	No.2	SPF							
R - O	2x4	DRY	No.2	SPF							
O - L	2x4	DRY	No.2	SPF							
ALL WEBS	2x3	DRY	No.2	SPF							
EXCEPT											
DRY: SEASONED LUMBER.											

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TTWW-m	MT20	5.0	8.0		Edge
E	TMVW-t	MT20	4.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMVW-w	MT20	2.0	4.0		
H	TTWW-m	MT20	5.0	8.0		Edge
I	TMVW-t	MT20	4.0	4.0	2.00	1.50
J	TMVW-p	MT20	5.0	6.0	1.75	2.75
L	BMV1-p	MT20	3.0	4.0		
M	BMVW-t	MT20	5.0	6.0	2.50	2.75
N	BMVW-t	MT20	4.0	4.0		
O	BS-t	MT20	3.0	6.0		
P	BMVW-w	MT20	4.0	9.0		
Q	BMVW-t	MT20	4.0	6.0		
R	BS-t	MT20	3.0	6.0		
S	BMVW-t	MT20	4.0	4.0		
T	BMVW-t	MT20	5.0	6.0	2.50	2.75
U	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.


BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-P.


END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING				TOTAL LOAD CASES: (4)			
CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8 -91.8	0.12 (1)	T-C	-396 / 0	0.11 (1)	
B-C	-2270 / 0	-91.8 -91.8	0.37 (1)	C-S	-79 / 0	0.05 (1)	
C-D	-2254 / 0	-91.8 -91.8	0.38 (1)	S-D	0 / 156	0.04 (4)	
D-E	-2485 / 0	-91.8 -91.8	0.64 (1)	D-Q	0 / 949	-0.21 (1)	
E-F	-2484 / 0	-91.8 -91.8	0.64 (1)	Q-E	-597 / 0	0.52 (1)	
F-G	-2484 / 0	-91.8 -91.8	0.64 (1)	E-P	-2 / 0	0.00 (1)	
G-H	-2484 / 0	-91.8 -91.8	0.63 (1)	P-G	-597 / 0	0.52 (1)	
H-I	-2254 / 0	-91.8 -91.8	0.36 (1)	P-H	0 / 947	0.21 (1)	
I-J	-2270 / 0	-91.8 -91.8	0.37 (1)	N-H	0 / 157	0.04 (4)	
J-K	0 / 35	-91.8 -91.8	0.12 (1)	N-I	-78 / 0	0.05 (1)	
U-B	-2027 / 0	0.0 0.0	0.21 (1)	M-I	-397 / 0	0.11 (1)	
L-J	-2026 / 0	0.0 0.0	0.21 (1)	B-T	0 / 1966	0.44 (1)	
				M-J	0 / 1966	0.44 (1)	
U-T	0 / 0	-18.5 -18.5	0.08 (4)				
T-S	0 / 1909	-18.5 -18.5	0.37 (1)				
S-R	0 / 1854	-18.5 -18.5	0.38 (1)				
R-Q	0 / 1854	-18.5 -18.5	0.38 (1)				
Q-P	0 / 2485	-18.5 -18.5	0.47 (1)				
P-O	0 / 1854	-18.5 -18.5	0.36 (1)				
O-N	0 / 1854	-18.5 -18.5	0.36 (1)				
N-M	0 / 1909	-18.5 -18.5	0.37 (1)				
M-L	0 / 0	-18.5 -18.5	0.08 (4)				

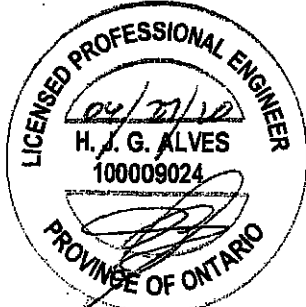

Structural component only
DWG# T-2006956

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408087	T5	2	1	GREEN PARK HOMES	
TAMERACK ROOF TRUSS, BURLINGTON					

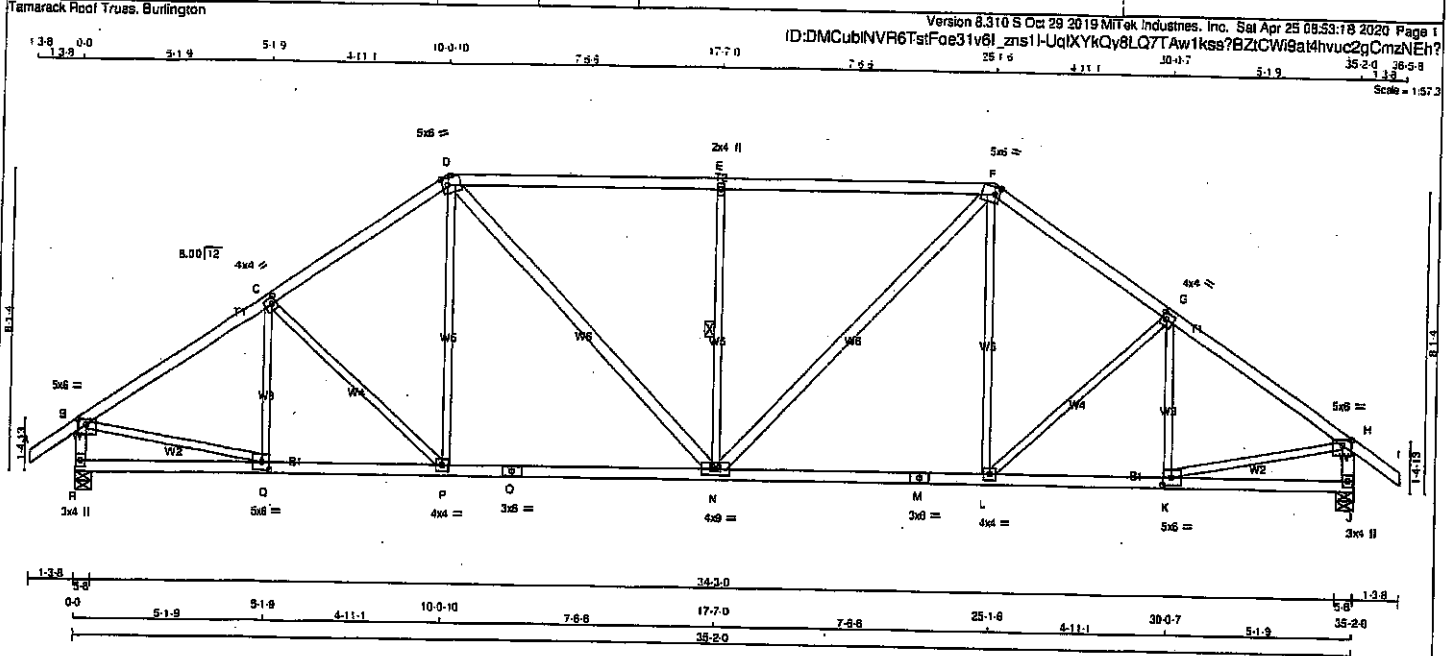

LUMBER	SIZE	DRY	NO.2
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE				
B TMWV-p	MT20	5.0	8.0	1.75 2.75
C TMWV-W	MT20	4.0	4.0	2.00 1.50
D TMWV-m	MT20	5.0	8.0	2.25 1.75
E TMW-w	MT20	2.0	4.0	
F TMWV-m	MT20	5.0	8.0	2.25 1.75
G TMWV-W	MT20	4.0	4.0	2.00 1.50
H TMWV-p	MT20	5.0	8.0	1.75 2.75
J BMV1-p	MT20	3.0	4.0	
K BMWV-W	MT20	5.0	8.0	2.50 2.75
L BMWV-W	MT20	4.0	4.0	
M BS-1	MT20	3.0	8.0	
N BMWV-W	MT20	4.0	9.0	
O BS-1	MT20	3.0	8.0	
P BMWV-W	MT20	4.0	4.0	
Q BMWV-W	MT20	5.0	8.0	2.50 2.75
R BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	DOWN	IN-SX	IN-SX
R	2085 0	2085 0	5-8	5-8
J	2085 0	2085 0	5-8	5-8

UNFACTORED REACTIONS	1ST CASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
R	1458 970 / 0	0 / 0 0 / 0 0 / 0 488 / 0 0 / 0
J	1458 970 / 0	0 / 0 0 / 0 0 / 0 488 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING	TOTAL LOAD CASES: (4)
CHORDS	WEBS
MEMB.	MEMB.
MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
VERT. LOAD LGT MAX (PLF)	MAX. FACTORED CS (LC)
FROM TO	FROM TO
A-B	0 / 35
B-C	-2318 / 0
C-D	-2186 / 0
D-E	-2275 / 0
E-F	-2275 / 0
F-G	-2186 / 0
G-H	-2318 / 0
H-I	0 / 35
I-J	-2022 / 0
J-K	-2022 / 0
R-Q	0 / 0
Q-P	0 / 1953
P-O	0 / 1794
O-N	0 / 1794
N-M	0 / 1794
M-L	0 / 1794
L-K	0 / 1953
K-J	0 / 0

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
OL = 6.0 PSF
BOT CH. LL = 0.0 PSF
OL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.22")

CSI: TC=0.81/1.00 (D-E-1), SC=0.41/1.00 (N-P-1), WB=0.45/1.00 (B-C-1), SS=0.34/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (B) (INPUT = 0.90)

JSI METAL= 0.57 (C) (INPUT = 1.00)



Structural component only
DWG# T-2006957

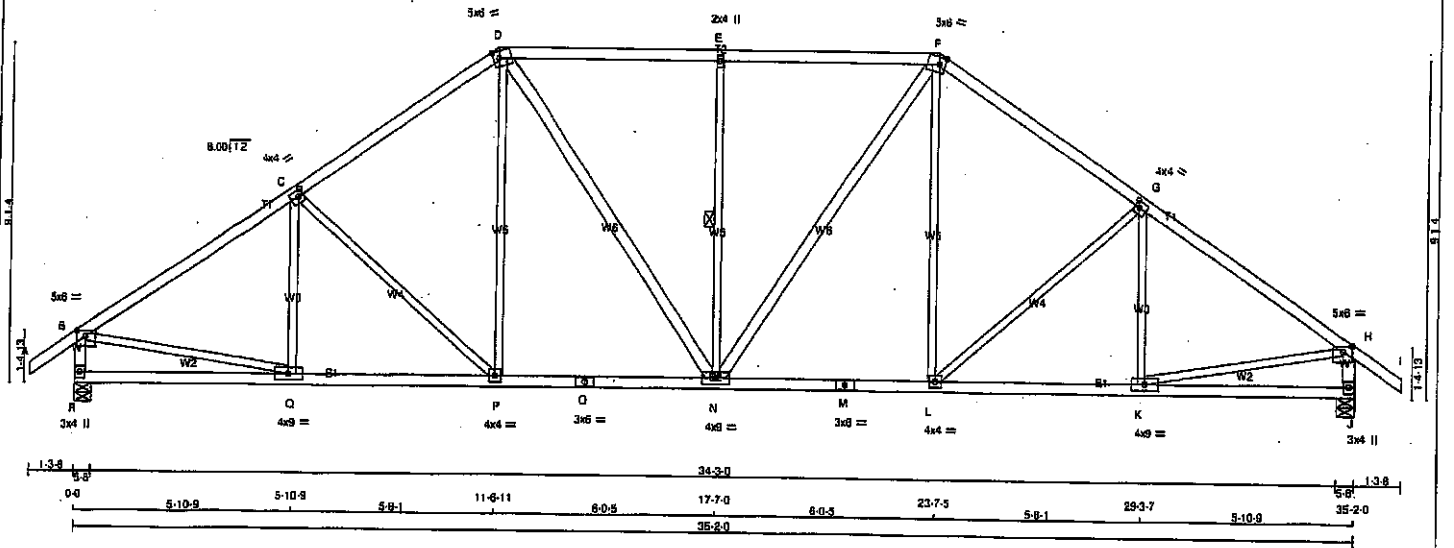

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
R - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
R - O	2x4	DRY	No.2	SPF
O - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
D - N	2x4	DRY	No.2	SPF
N - F	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TMVW-i	MT20	4.0	4.0	2.00	1.50
D	TTVW-m	MT20	5.0	6.0	2.25	2.00
E	TMVW-w	MT20	2.0	4.0		
F	TTVW-m	MT20	5.0	6.0	2.25	2.00
G	TMVW-i	MT20	4.0	4.0	2.00	1.50
H	TMVW-p	MT20	5.0	6.0	1.75	2.75
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-i	MT20	4.0	9.0		
L	BMVW-i	MT20	4.0	4.0		
M	BS-t	MT20	3.0	6.0		
N	BMVW-wt	MT20	4.0	9.0		
O	BS-t	MT20	3.0	6.0		
P	BMVW-i	MT20	4.0	4.0		
Q	BMVW-i	MT20	4.0	9.0		
R	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REORD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
R	2085	0	2085	0	5-8	5-8
J	2085	0	2085	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE COMBINED		MAX./MIN. COMPONENT REACTIONS				
	SNOW	LIVE	PERM.	LIVE	WIND	DEAD	SOIL
R	1458	970/0	0/0	0/0	0/0	488/0	0/0
J	1458	970/0	0/0	0/0	0/0	488/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1		MAX. UNBRAC LENGTH FR-TO	WEBS MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
		FROM	TO			
FR-TO						
A-B	0/35	-91.8	-91.8	0.12 (1)	10.00	0.11 (1)
B-C	-2347/0	-91.8	-91.8	0.52 (1)	3.99	0.42 (1)
C-D	-2096/0	-91.8	-91.8	0.48 (1)	4.22	0.08 (1)
D-E	-1985/0	-91.8	-91.8	0.49 (1)	4.26	0/477
E-F	-1985/0	-91.8	-91.8	0.49 (1)	4.26	0/477
F-G	-2096/0	-91.8	-91.8	0.48 (1)	4.22	0/477
G-H	-2347/0	-91.8	-91.8	0.52 (1)	3.99	0/342
H-I	0/35	-91.8	-91.8	0.12 (1)	10.00	0.11 (1)
I-J	-2018/0	0.0	0.0	0.21 (1)	5.94	0/2014
J-K	-2018/0	0.0	0.0	0.21 (1)	5.94	0/2014
K-L	0/0	-18.5	-18.5	0.14 (4)	10.00	0.45 (1)
L-M	0/1981	-18.5	-18.5	0.39 (1)	10.00	0.45 (1)
M-N	0/1716	-18.5	-18.5	0.34 (1)	10.00	0.45 (1)
N-O	0/1716	-18.5	-18.5	0.34 (1)	10.00	0.45 (1)
O-P	0/1716	-18.5	-18.5	0.34 (1)	10.00	0.45 (1)
P-Q	0/1716	-18.5	-18.5	0.34 (1)	10.00	0.45 (1)
Q-R	0/1981	-18.5	-18.5	0.39 (1)	10.00	0.45 (1)
R-S	0/0	-18.5	-18.5	0.14 (4)	10.00	0.45 (1)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF

BOT CH. LL = 0.0 PSF
DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.19")

CSI: TC=0.52/1.00 (B-C:1), BC=0.39/1.00 (K-L:1), WB=0.45/1.00 (H-K:1), SSI=0.27/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.87 (B) (INPUT = 0.90)
JSI METAL= 0.56 (M) (INPUT = 1.00)



Structural component only
DWG# T-2006958

JOB NAME 408087	TRUSS NAME 17	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:53:19 2020 Page 1
 ID:DMCubINVR6TstFoe31v6l_zms11-y1Jw4RavfY25KVEZOeknQPE6Vcx827GoDKCZNEH
 35-2-0 35-5-8 1-3-8 1-3-8
 Scale = 1/32"

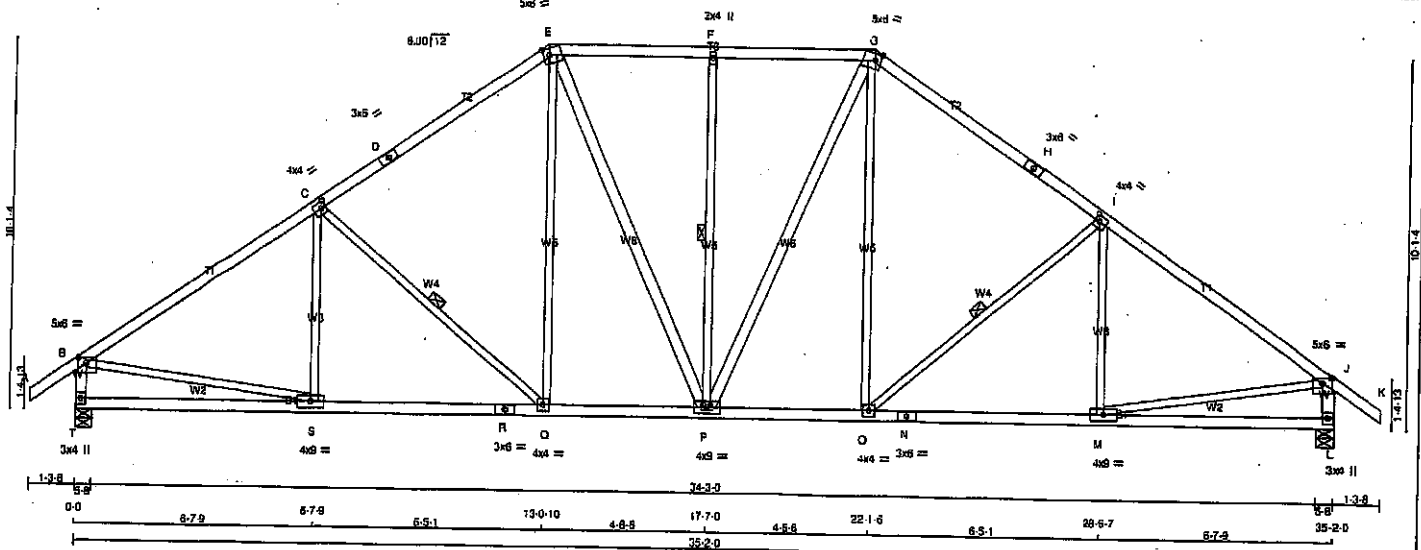

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
T - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
T - R	2x4	DRY	No.2
R - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
E - P	2x4	DRY	No.2
P - G	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	6.0	1.75	2.75
C TMVW-l	MT20	4.0	4.0	2.00	1.50
D TS-l	MT20	3.0	6.0		
E TTWW-m	MT20	5.0	6.0	2.25	2.00
F TMVW-w	MT20	2.0	4.0		
G TTWW-m	MT20	5.0	6.0	2.25	2.00
H TS-l	MT20	3.0	6.0		
I TMVW-l	MT20	4.0	4.0	2.00	1.50
J TMVW-p	MT20	5.0	6.0	1.75	2.75
L BMV1-p	MT20	3.0	4.0		
M BMVW-l	MT20	4.0	9.0		
N BS-l	MT20	3.0	6.0		
O BMVW-l	MT20	4.0	4.0		
P BMVW-w	MT20	4.0	9.0		
Q BMVW-l	MT20	4.0	4.0		
R BS-l	MT20	3.0	6.0		
S BMVW-l	MT20	4.0	9.0		
T BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
T	2065	0	2065	0	5-8	5-8
L	2065	0	2065	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERMILIVE			
T	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
 ALL PITCH BREAKS AND PERMETER CORNER JOINTS MUST BE Laterally RESTRAINED.
 1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-Q, F-P, I-O.
 END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
 TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1		MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH
		FROM	TO				
FR-TO					FR-TO		
A-B	0 / 35	-91.8	-91.8	0.12 (1)	S-C	-189 / 46	0.10 (1)
B-C	-2359 / 0	-91.8	-91.8	0.69 (1)	C-Q	-485 / 0	0.24 (1)
C-D	-1996 / 0	-91.8	-91.8	0.62 (1)	Q-E	0 / 416	0.09 (1)
D-E	-1996 / 0	-91.8	-91.8	0.62 (1)	E-P	0 / 315	0.05 (1)
E-F	-1762 / 0	-91.8	-91.8	0.27 (1)	P-F	-502 / 0	0.35 (1)
F-G	-1762 / 0	-91.8	-91.8	0.27 (1)	P-G	0 / 315	0.05 (1)
G-H	-1996 / 0	-91.8	-91.8	0.62 (1)	O-G	0 / 416	0.09 (1)
H-I	-1996 / 0	-91.8	-91.8	0.62 (1)	O-I	-485 / 0	0.24 (1)
I-J	-2359 / 0	-91.8	-91.8	0.69 (1)	M-I	-189 / 46	0.10 (1)
J-K	0 / 35	-91.8	-91.8	0.12 (1)	B-S	0 / 2022	0.45 (1)
T-B	-2014 / 0	0.0	0.0	0.21 (1)	M-J	0 / 2022	0.45 (1)
L-J	-2014 / 0	0.0	0.0	0.21 (1)			
T-S	0 / 0	-18.5	-18.5	0.19 (4)			
S-R	0 / 1996	-18.5	-18.5	0.42 (1)			
R-Q	0 / 1996	-18.5	-18.5	0.42 (1)			
Q-P	0 / 1630	-18.5	-18.5	0.32 (1)			
P-O	0 / 1630	-18.5	-18.5	0.32 (1)			
O-N	0 / 1996	-18.5	-18.5	0.42 (1)			
N-M	0 / 1996	-18.5	-18.5	0.42 (1)			
M-L	0 / 0	-18.5	-18.5	0.19 (4)			

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, OBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
 CALCULATED VERT. DEFL.(LL) = L/989 (0.09)
 ALLOWABLE DEFL.(TL) = L/360 (1.17)
 CALCULATED VERT. DEFL.(TL) = L/989 (0.18)

CS: TC=0.69/1.00 (I-J:1), BC=0.42/1.00 (M-O:1),
 WB=0.45/1.00 (J-M:1), SS=0.24/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1666

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.87 (S) (INPUT = 0.90)
 JSI METAL = 0.58 (N) (INPUT = 1.00)



Structural component only
 DWG# T-2006959

Tamarack Roof Truss, Burlington Version 8.310 S Oct 29 2019 Metek Industries, Inc. Sat Apr 25 08:53:20 2020 Page 1
ID:DMCubINV6R6TstFoe31v6I_zns1I-QDtlzPRCgzhqU4CsHvTH_yd_WsIL_EBMwXnFzNEgz
Scale = 1:16.5

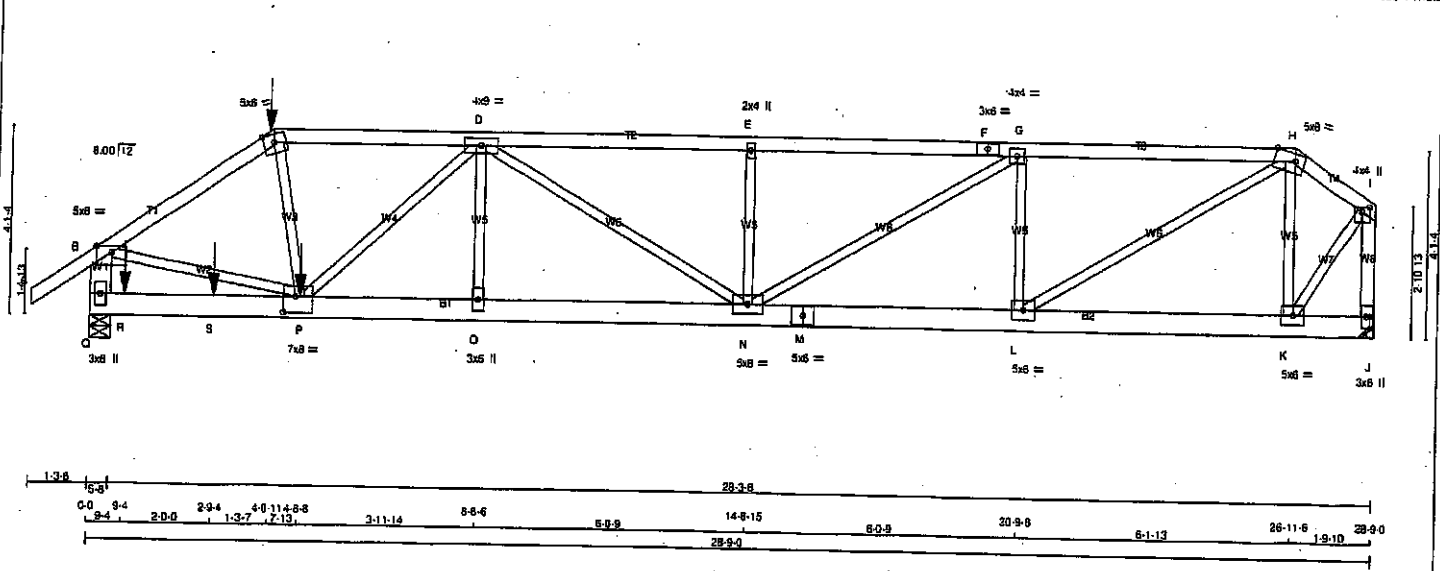

LUMBER

N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR
A - C	2x4	DRY	No.2	SPF
C - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - I	2x4	DRY	No.2	SPF
I - J	2x4	DRY	No.2	SPF
J - K	2x4	DRY	No.2	SPF
K - L	2x4	DRY	No.2	SPF
L - M	2x4	DRY	No.2	SPF
M - N	2x4	DRY	No.2	SPF
N - O	2x4	DRY	No.2	SPF
O - P	2x4	DRY	No.2	SPF
P - Q	2x4	DRY	No.2	SPF
Q - R	2x4	DRY	No.2	SPF
R - S	2x4	DRY	No.2	SPF
S - T	2x4	DRY	No.2	SPF
T - U	2x4	DRY	No.2	SPF
U - V	2x4	DRY	No.2	SPF
V - W	2x4	DRY	No.2	SPF
W - X	2x4	DRY	No.2	SPF
X - Y	2x4	DRY	No.2	SPF
Y - Z	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.
DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #/ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE(81.0)
C - F	12	SIDE(81.0)
F - H	12	TOP
H - I	12	TOP
I - J	12	TOP
J - K	12	TOP
K - L	12	TOP
L - M	12	TOP
M - N	12	TOP
N - O	12	TOP
O - P	12	TOP
P - Q	12	TOP
Q - R	12	TOP
R - S	12	TOP
S - T	12	TOP
T - U	12	TOP
U - V	12	TOP
V - W	12	TOP
W - X	12	TOP
X - Y	12	TOP
Y - Z	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
Q - M	12	SIDE(183.1)
M - J	12	TOP
J - I	12	TOP
I - H	12	TOP
H - G	12	TOP
G - F	12	TOP
F - E	12	TOP
E - D	12	TOP
D - C	12	TOP
C - B	12	TOP
B - A	12	TOP
WEBS: (0.122"x3") SPIRAL NAILS		
C - P	4	SIDE(424.8)
P - Q	4	SIDE(424.8)
Q - R	4	SIDE(424.8)
R - S	4	SIDE(424.8)
S - T	4	SIDE(424.8)
T - U	4	SIDE(424.8)
U - V	4	SIDE(424.8)
V - W	4	SIDE(424.8)
W - X	4	SIDE(424.8)
X - Y	4	SIDE(424.8)
Y - Z	4	SIDE(424.8)

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.
TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	0	0
Q	HORIZ	UP	0	0
J	MECHANICAL	MECHANICAL	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 4-0.

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
JT	COMBINED SNOW	0/0	0/0	0/0
Q	DOWN	0/0	0/0	0/0
J	UP	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4-06 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10-00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	WELLS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)
FR-TO	A-B	0/35	-91.8	-91.8	0.07 (1)	FR-TO	D-O	0/133	0.02 (4)
	B-C	-4881/0	-91.8	-91.8	0.25 (1)		K-H	-1149/0	0.15 (1)
	C-D	-4441/0	-91.8	-91.8	0.29 (1)		S-P	0/4125	0.51 (1)
	D-E	-4732/0	-91.8	-91.8	0.35 (1)		K-I	0/1643	0.20 (1)
	E-F	-4732/0	-91.8	-91.8	0.43 (1)		C-P	0/2085	0.26 (1)
	F-G	-4732/0	-91.8	-91.8	0.43 (1)		P-D	-744/0	0.18 (1)
	G-H	-3457/0	-91.8	-91.8	0.36 (1)		L-H	0/2910	0.36 (1)
	H-I	-1204/0	-91.8	-91.8	0.03 (1)		D-N	-290/0	0.14 (1)
	I-J	-3859/0	0.0	0.0	0.14 (1)		L-G	-1411/0	0.18 (1)
	J-I	-2081/0	0.0	0.0	0.16 (1)		N-E	-535/0	0.07 (1)
	Q-R	0/0	-18.5	-18.5	0.08 (1)		N-G	0/1498	0.19 (1)
	R-S	0/0	-18.5	-18.5	0.08 (1)				
	S-P	0/0	-18.5	-18.5	0.08 (1)				
	P-O	0/4979	-18.5	-18.5	0.37 (1)				
	O-N	0/4979	-18.5	-18.5	0.38 (1)				
	N-M	0/3457	-18.5	-18.5	0.27 (1)				
	M-L	0/3457	-18.5	-18.5	0.27 (1)				
	L-K	0/986	-18.5	-18.5	0.10 (1)				
	K-J	0/0	-18.5	-18.5	0.04 (1)				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-11	-49	-55	---	FRONT	VERT	---	C1
C	4-0-11	-254	-254	---	FRONT	VERT	---	C1
P	4-8-8	-2329	-2329	---	FRONT	VERT	---	C1
R	9-4	-29	-29	---	FRONT	VERT	---	C1
S	2-9-4	-26	-26	---	FRONT	VERT	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	= 25.6 PSF
	DL	= 6.0 PSF
BOT CH.	LL	= 0.0 PSF
	DL	= 7.4 PSF
TOTAL LOAD		= 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD)
EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.98")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (0.98")
CALCULATED VERT. DEFL.(TL) = L/999 (0.21")

CSI: TC=0.43/1.00 (E-G:1), BC=0.37/1.00 (C-P:1),
WB=0.51/1.00 (B-P:1), SS=0.15/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (OR) SHEAR	SECTION (PL)	MAX MIN	MAX MIN	MAX MIN
MT20	818	354	1667	789
		1987	1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (C) INPUT = 0.90
JSI METAL = 0.47 (P) INPUT = 1.00



Structural component only
DWG# T-2006960

JOB NAME 408087	TRUSS NAME T8	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 08:53:20 2020 Page 2
ID:DMCubINVR6TstFoe31v6I zns1I-QDtlzPRCqzhqIU4Q8HvTH vd WstL EBMwXnFzNEqz

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTW-m	MT20	5.0	6.0	Edge	
D	TMWWW-t	MT20	4.0	9.0		
E	TMW-w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMWW-t	MT20	4.0	4.0		
H	TTWW-m	MT20	5.0	8.0	Edge 5.50	
I	TMVW-p	MT20	4.0	4.0	1.25 2.00	
J	BMV1-p	MT20	3.0	6.0		
K	BMWW-t	MT20	5.0	6.0		
L	BMWW-t	MT20	5.0	6.0		
M	BS-t	MT20	5.0	6.0		
N	BMWWW-t	MT20	5.0	8.0		
O	BMW-w	MT20	3.0	6.0		
P	BMWWW-t	MT20	7.0	8.0	4.25 3.25	
Q	BMV1-p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2006960 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408087	T9	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 08:53:21 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns11-uPRgAISqRGphLdtP_CipCVBwAS4TDLaaHKn4zNEgy

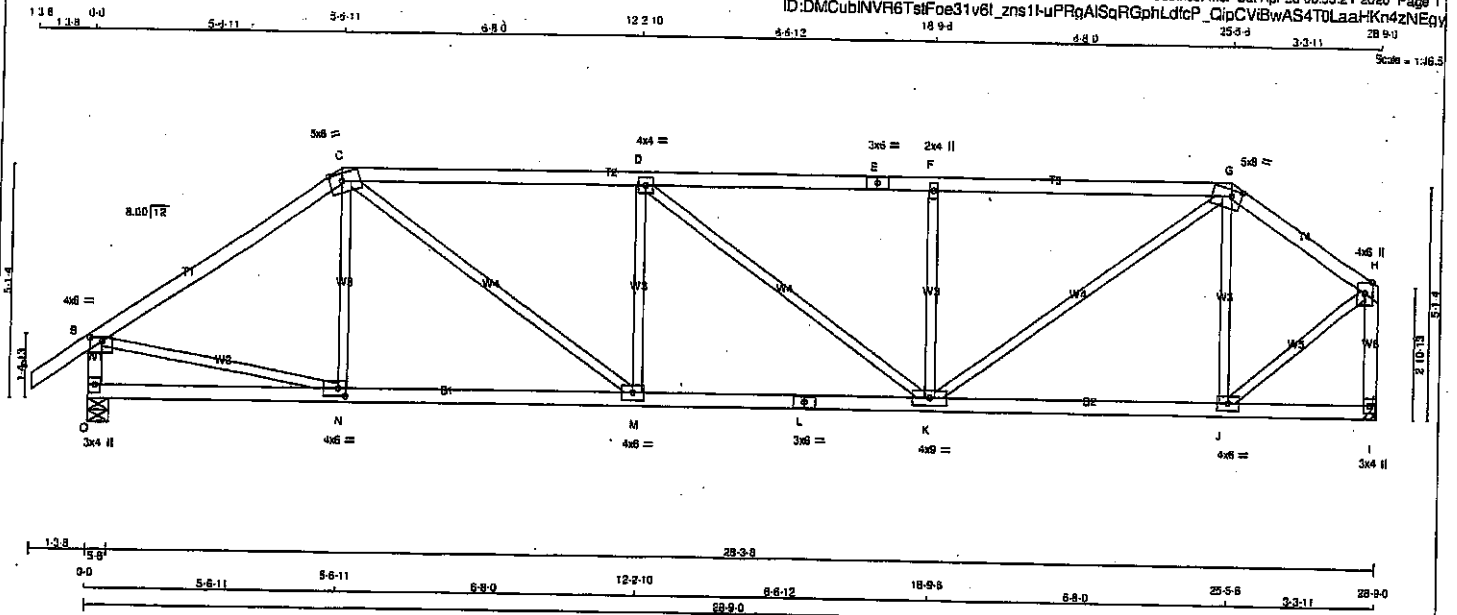

LUMBER	N. L. G. A. RULES	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - H	2x4	DRY	No.2	SPF
O - B	2x4	DRY	No.2	SPF
I - H	2x4	DRY	No.2	SPF
O - L	2x4	DRY	No.2	SPF
L - I	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	6.0	1.00	3.25
C	TTWW-m	MT20	5.0	8.0	2.00	3.25
D	TMVW-i	MT20	4.0	4.0		
E	TS-i	MT20	3.0	6.0		
F	TMVW-w	MT20	2.0	4.0		
G	TTWW-m	MT20	5.0	8.0	1.75	2.75
H	TMVW-p	MT20	4.0	6.0	Edge	
I	BMV1-p	MT20	3.0	4.0		
J	BMVW-i	MT20	4.0	6.0		
K	BMVW-i	MT20	4.0	6.0		
L	BS-i	MT20	3.0	6.0		
M	BMVW-i	MT20	4.0	6.0		
N	BMVW-i	MT20	4.0	6.0	2.00	2.00
O	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	IN-SX	IN-SX
O	1711	0	5-8	5-8
I	1585	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS

1ST CASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED
O	1208
I	1121

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.59 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	FORCE	VERT. LOAD	LC1	MAX	MAX. UNBRAC	CS1(LC)	LENGTH	FR-TO	MEMB.	MAX. FACTORED	FORCE	MAX	CS1(LC)
A-B		0/35									A-C	-159/42		0.08	(1)
B-C		-1804/0		-91.8	-91.8	0.12	(1)	10.00			C-M	0/1121		0.25	(1)
C-D		-2406/0		-91.8	-91.8	0.79	(1)	3.59			M-D	-538/0		0.21	(1)
D-E		-2236/0		-91.8	-91.8	0.75	(1)	3.73			D-K	-210/0		0.29	(1)
E-F		-2236/0		-91.8	-91.8	0.75	(1)	3.73			K-F	-680/0		0.25	(1)
F-G		-2236/0		-91.8	-91.8	0.75	(1)	3.74			K-G	0/1548		0.35	(1)
G-H		-1196/0		-91.8	-91.8	0.19	(1)	5.62			J-G	-642/0		0.25	(1)
O-B		-1670/0		0.0	0.0	0.17	(1)	6.42			B-N	0/1526		0.34	(1)
I-H		-1570/0		0.0	0.0	0.24	(1)	6.58			J-H	0/1246		0.28	(1)
O-N		0/0		-18.5	-18.5	0.16	(4)	10.00							
N-M		0/1496		-18.5	-18.5	0.33	(1)	10.00							
M-L		0/2406		-18.5	-18.5	0.46	(1)	10.00							
L-K		0/2406		-18.5	-18.5	0.46	(1)	10.00							
K-J		0/980		-18.5	-18.5	0.24	(4)	10.00							
J-I		0/0		-18.5	-18.5	0.12	(4)	10.00							

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.96")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (0.96")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSK TC=0.79/1.00 (C-D:1), BC=0.48/1.00 (K-M:1), WS=0.35/1.00 (G-K:1), SS=0.28/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.88 (B) (INPUT = 0.90)
JSI METAL = 0.79 (L) (INPUT = 1.00)




Structural component only
DWG# T-2006961

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408087	T10S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 08:53:22 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1I-Mb72O5TScaxYynEozhxxMP2yaYspwUpE0uKXzNEgX

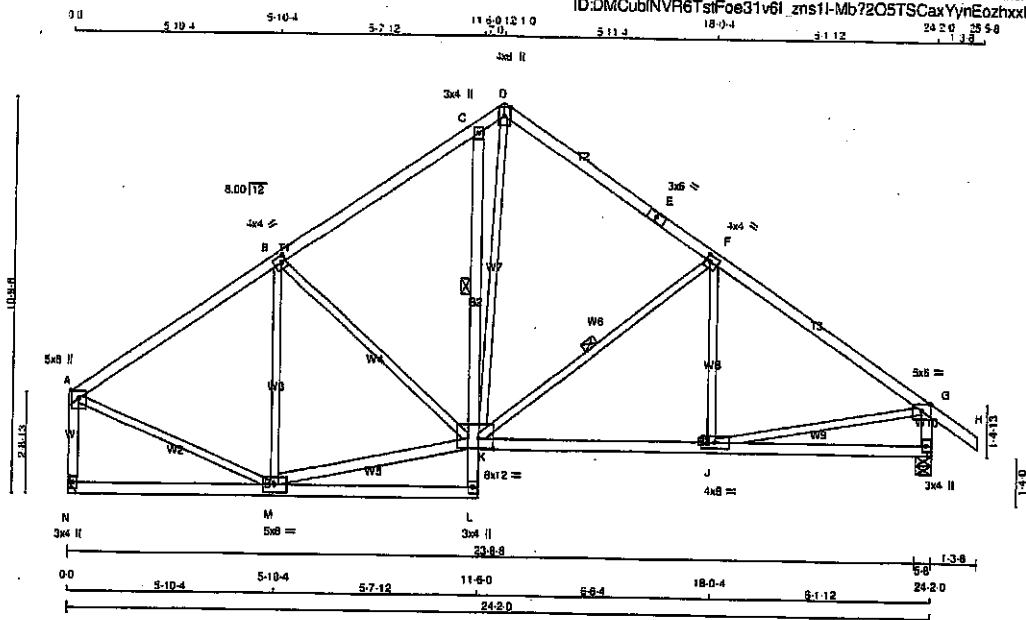

Scale = 1/8" = 1'-0"

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
A - D	2x4	DRY No.2
D - E	2x4	DRY No.2
E - H	2x4	DRY No.2
N - A	2x4	DRY No.2
I - G	2x4	DRY No.2
N - L	2x4	DRY No.2
L - C	2x4	DRY No.2
K - I	2x4	DRY No.2

ALL WEBS	2x3	DRY No.2
EXCEPT		
M - K	2x4	DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	5.0	8.0	Edge	
B	TMVW-i	MT20	4.0	4.0	2.00	1.50
C	TMV+p	MT20	3.0	4.0		
D	TMV+p	MT20	4.0	8.0	Edge	
E	TS-i	MT20	3.0	8.0		
F	TMVW-i	MT20	4.0	4.0	2.00	1.50
G	TMVW-p	MT20	5.0	8.0	Edge	
I	BMV1-p	MT20	3.0	4.0		
J	BMVW-i	MT20	4.0	9.0		
K	BMVW-ww	MT20	8.0	12.0	3.25	5.00
L	BMV+p	MT20	3.0	4.0		
M	BMVW-i	MT20	5.0	8.0		
N	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
N	1332	0	1332	0
I	1458	0	1458	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT N. MINIMUM BEARING LENGTH AT JOINT N = 3'-8".

UNFACTORED REACTIONS

JT	1ST LOASE	MAX. MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
N	942	618 / 0	0 / 0	0 / 0	0 / 0
I	1029	689 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.80 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-K, F-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	-1161 / 0	-91.8 -91.8	0.40 (1)	5.41	M-B	-525 / 0	0.38 (1)
B-C	-1153 / 0	-91.8 -91.8	0.38 (1)	5.46	M-K	0 / 1022	0.16 (1)
C-D	-1180 / 0	-91.8 -91.8	0.10 (1)	5.78	B-K	-90 / 0	0.10 (1)
D-E	-1061 / 0	-91.8 -91.8	0.45 (1)	5.52	K-D	0 / 1053	0.24 (1)
E-F	-1061 / 0	-91.8 -91.8	0.45 (1)	5.52	K-F	-534 / 0	0.26 (1)
F-G	-1494 / 0	-91.8 -91.8	0.49 (1)	4.80	J-F	-80 / 88	0.04 (1)
G-H	0 / 35	-91.8 -91.8	0.12 (1)	10.00	A-M	0 / 1077	0.24 (1)
N-A	-1281 / 0	0.0 0.0	0.19 (1)	7.10	J-G	0 / 1293	0.29 (1)
I-G	-1415 / 0	0.0 0.0	0.15 (1)	6.85			
N-M	0 / 0	-18.5 -18.5	0.17 (4)	10.00			
M-L	0 / 10	-18.5 -18.5	0.17 (4)	10.00			
L-K	0 / 44	0.0 0.0	0.02 (1)	10.00			
K-C	-337 / 0	0.0 0.0	0.03 (1)	6.25			
K-J	0 / 1273	-18.5 -18.5	0.32 (4)	10.00			
J-I	0 / 0	-18.5 -18.5	0.21 (4)	10.00			

TOTAL WEIGHT = 2 X 122 = 244 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPG 2011, TPG 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.81")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CSI-TC=0.49/1.00 (F-G:1), BC=0.32/1.00 (J-K:4),
WB=0.38/1.00 (B-M:1), SSI=0.23/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1657 788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.82 (G) (INPUT = 0.80)
JSI METAL= 0.48 (A) (INPUT = 1.00)

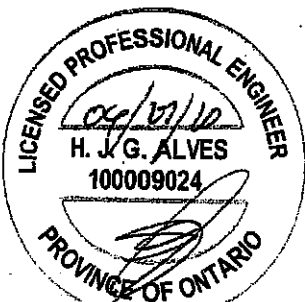

Structural component only
DWG# T-2006962

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408087	T11	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
TRUSS DESC.					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 08:53:22 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-Mb?2Q5TS CaxYynEozhxxMP2z9Jb7p_NUpEouKXznEpx

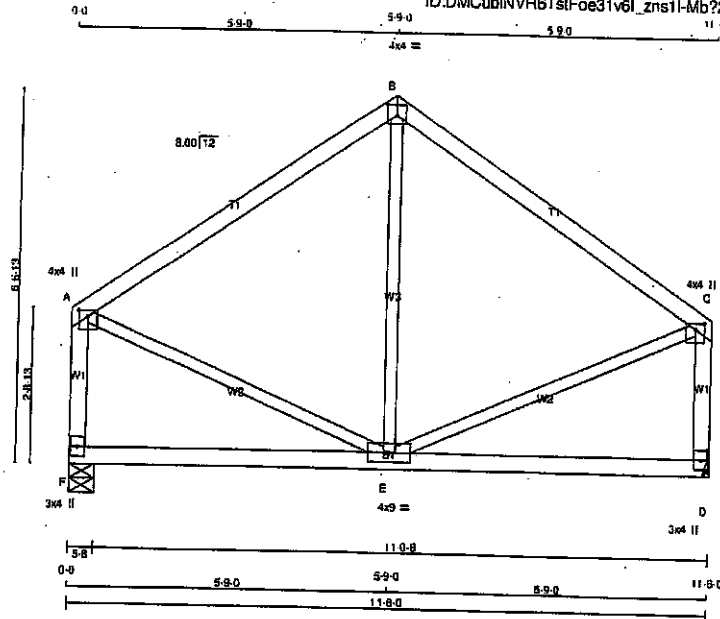

Scale = 1/32" = 1'-0"

LUMBER	N.L.G.A. RULES	CHORDS	SIZE	DRY	LUMBER
A - B	2x4	DRY	No.2		
B - C	2x4	DRY	No.2		
F - A	2x4	DRY	No.2		
D - C	2x4	DRY	No.2		
F - D	2x4	DRY	No.2		

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TTW+p	MT20	4.0	4.0	2.25	2.00
C	TMVW+p	MT20	4.0	4.0	1.25	2.00
D	BMV1+p	MT20	3.0	4.0		
E	BMVWW+1	MT20	4.0	9.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	UP/LIFT	IN-SX
F	834	0	0	5-8
D	834	0	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	448	294 / 0	0 / 0	0 / 0	0 / 0	154 / 0	0 / 0
D	448	294 / 0	0 / 0	0 / 0	0 / 0	154 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD LC1	MEMB.	FORCE
	(LBS)	TO		(LBS)
FR-TO		FROM	FR-TO	
A-B	-365 / 0	-91.8 -91.8 0.39 (1)	E-B	-123 / 54
B-C	-365 / 0	-91.8 -91.8 0.39 (1)	A-E	0 / 329
F-A	-593 / 0	0.0 0.0 0.09 (1)	E-C	0 / 329
D-C	-593 / 0	0.0 0.0 0.09 (1)		
F-E	0 / 0	-18.5 -18.5 0.18 (4)		
E-D	0 / 0	-18.5 -18.5 0.18 (4)		

TOTAL WEIGHT = 2 X 49 = 98 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.38")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.38")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CSI: TC=0.39/1.00 (A-B:1), BC=0.18/1.00 (D-E:4), WB=0.09/1.00 (B-E:1), SS=0.17/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1687	788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.41 (C) (INPUT = 0.90)
JSI METAL= 0.12 (A) (INPUT = 1.00)



Structural component only
DWG# T-2006963

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408087	T11S	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

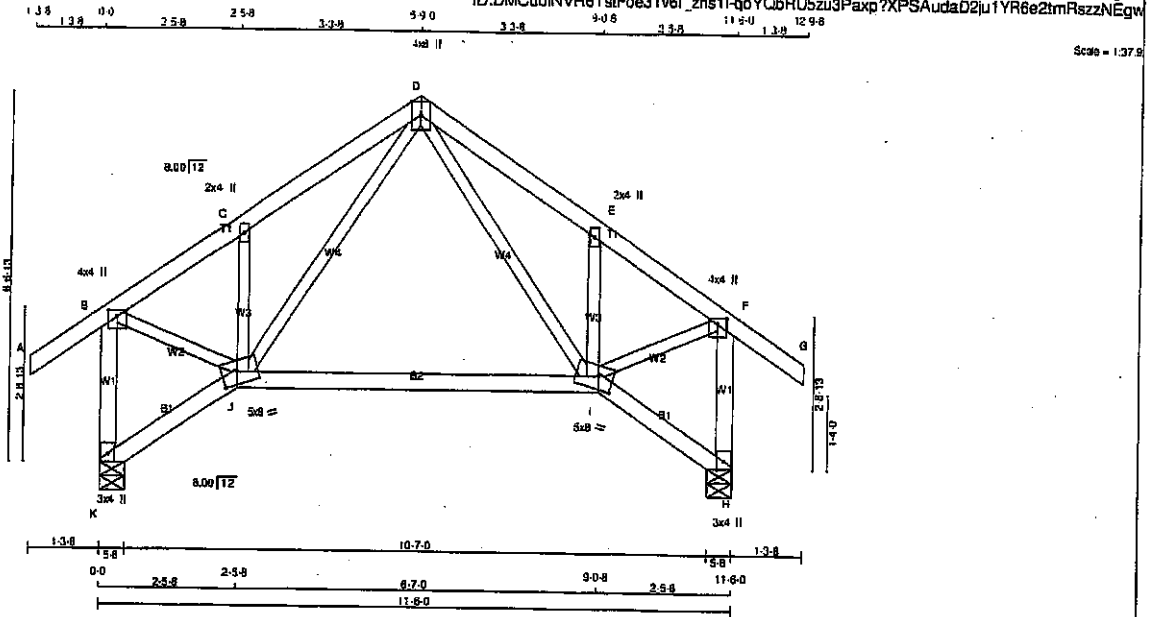

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
K - B	2x4 DRY	No.2	SPF		
A - D	2x4 DRY	No.2	SPF		
D - G	2x4 DRY	No.2	SPF		
H - F	2x4 DRY	No.2	SPF		
K - J	2x4 DRY	No.2	SPF		
J - I	2x4 DRY	No.2	SPF		
I - H	2x4 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
SEASONED LUMBER.					

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TMVW+w	MT20	2.0	4.0		
D	TTVW+w	MT20	4.0	8.0	Edge	
E	TMVW+p	MT20	2.0	4.0		
F	TMVW+w	MT20	4.0	4.0	1.25	2.00
H	BMV1+p	MT20	3.0	4.0	Edge	
I	BBWWV+m	MT20	5.0	8.0	2.75	3.25
J	BBWWV-m	MT20	5.0	8.0	2.75	3.25
K	BMV1+p	MT20	3.0	4.0	Edge	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
K	760	0	760	0
H	760	0	760	0

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	535	364/0	0/0	0/0	0/0	171/0	0/0
H	535	364/0	0/0	0/0	0/0	171/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (1)	MAX. LC2 (1)	MAX. UNBRACED LENGTH (FT)	FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (1)	MAX. LC2 (1)
K-B	-737/0	0.0	0.0	0.12 (1)	7.81	D-I	0/241	0.05 (1)			
A-B	0/35	-91.8	-91.8	0.12 (1)	10.00	E	-326/0	0.08 (1)			
B-C	-562/0	-91.8	-91.8	0.09 (1)	8.25	F	0/527	0.12 (1)			
C-D	-559/0	-91.8	-91.8	0.11 (1)	6.25	J-D	0/241	0.05 (1)			
D-E	-599/0	-91.8	-91.8	0.11 (1)	6.25	J-C	-326/0	0.08 (1)			
E-F	-562/0	-91.8	-91.8	0.09 (1)	6.25	B-J	0/527	0.12 (1)			
F-G	0/35	-91.8	-91.8	0.12 (1)	10.00						
H-F	-737/0	0.0	0.0	0.12 (1)	7.81						
K-J	0/0	-18.5	-18.5	0.03 (4)	10.00						
J-I	0/352	-18.5	-18.5	0.28 (4)	10.00						
I-H	0/0	-18.5	-18.5	0.03 (4)	10.00						

TOTAL WEIGHT = 3 X 57 = 170 lb [M/F]

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.38")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.38")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.10")

CSI: TC=0.12/1.00 (A-B:1), BC=0.26/1.00 (I-J:4),
WB=0.12/1.00 (B-J:1), SS=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618	354
	1667	788
	1997	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.54 (F) (INPUT = 0.90)
JSI METAL= 0.24 (K) (INPUT = 1.00)

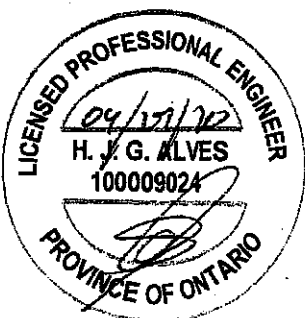

Structural component only
DWG# T-2006964

Famarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 08:53:24 2020 Page 1
ID:DMCubINV6TstFoe31v6l_zns11-H_6oonUjKBBGC5OB58zPRq7EX79FHiznGXV_OPzNEqV

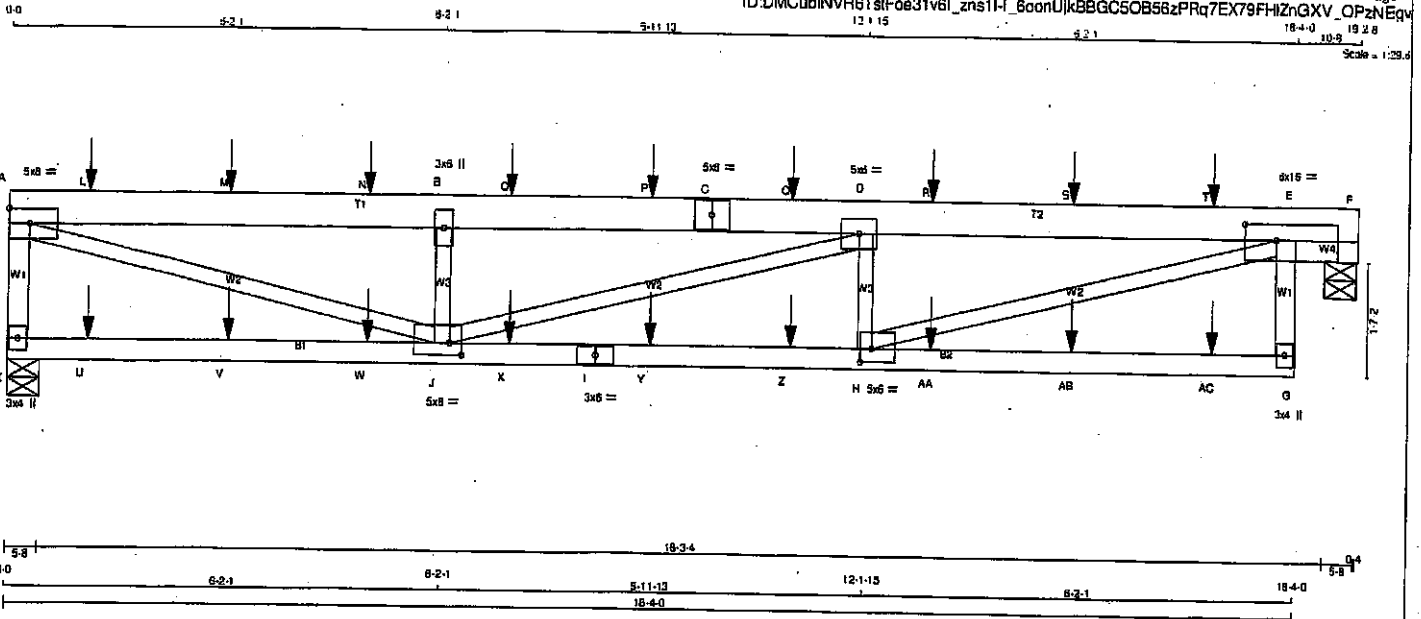

LUMBER

N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
K - A	2x4	DRY No.2	SPF
A - C	2x6	DRY No.2	SPF
C - F	2x6	DRY No.2	SPF
E - F	2x4	DRY No.2	SPF
G - E	2x4	DRY No.2	SPF
K - I	2x4	DRY No.2	SPF
I - G	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
K-A 1	12	TOP
E-G 1	12	TOP
A-C 2	12	SIDE(0.0)
C-F 2	12	SIDE(0.0)
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
K-I 1	12	SIDE(0.0)
I-G 1	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	
2x4 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-D INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	IN-SX	IN-SX
K	2110	0	5-8	5-8
F	1995	0	5-8	5-8

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): F

UNFACTORED REACTIONS

1ST LOASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
K	1482	979 / 0	0 / 0	0 / 0	513 / 0	0 / 0
F	1410	933 / 0	0 / 0	0 / 0	476 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.04 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)
FR-TO				MEMB.		
K-A	-1971 / 0	0.0	0.0 0.12 (1)	H-E	0 / 5502	0.88 (1)
A-L	-4759 / 0	-91.8	-91.8 0.30 (1)	A-J	0 / 4995	0.62 (1)
L-M	-4759 / 0	-91.8	-91.8 0.30 (1)	H-D	-1323 / 0	0.11 (1)
M-N	-4759 / 0	-91.8	-91.8 0.30 (1)	J-B	-895 / 0	0.08 (1)
N-B	-4759 / 0	-91.8	-91.8 0.30 (1)	J-D	-508 / 0	0.18 (1)
B-O	-4759 / 0	-91.8	-91.8 0.33 (1)			
O-P	-4759 / 0	-91.8	-91.8 0.33 (1)			
P-C	-4759 / 0	-91.8	-91.8 0.33 (1)			
C-Q	-4759 / 0	-91.8	-91.8 0.33 (1)			
Q-D	-4759 / 0	-91.8	-91.8 0.33 (1)			
D-R	-5242 / 0	-91.8	-91.8 0.72 (1)			
R-S	-5242 / 0	-91.8	-91.8 0.72 (1)			
S-T	-5242 / 0	-91.8	-91.8 0.72 (1)			
T-E	-5242 / 0	-91.8	-91.8 0.72 (1)			
E-F	-788 / 0	-91.8	-91.8 0.38 (1)			
G-E	0 / 140	0.0	0.0 0.01 (4)			

MEMB.	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
L	1-1-7	-151	-151	---	BACK	VERT	TOTAL	---	C1
M	3-1-7	-151	-151	---	BACK	VERT	TOTAL	---	C1
N	5-1-7	-151	-151	---	BACK	VERT	TOTAL	---	C1
O	7-1-7	-151	-151	---	BACK	VERT	TOTAL	---	C1
P	9-1-7	-151	-151	---	BACK	VERT	TOTAL	---	C1
Q	11-1-7	-151	-151	---	BACK	VERT	TOTAL	---	C1
R	13-1-7	-151	-151	---	BACK	VERT	TOTAL	---	C1

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
L	1-1-7	-151	-151	---	BACK	VERT	TOTAL	---	C1
M	3-1-7	-151	-151	---	BACK	VERT	TOTAL	---	C1
N	5-1-7	-151	-151	---	BACK	VERT	TOTAL	---	C1
O	7-1-7	-151	-151	---	BACK	VERT	TOTAL	---	C1
P	9-1-7	-151	-151	---	BACK	VERT	TOTAL	---	C1
Q	11-1-7	-151	-151	---	BACK	VERT	TOTAL	---	C1
R	13-1-7	-151	-151	---	BACK	VERT	TOTAL	---	C1

TOTAL WEIGHT = 2 X 77 = 154 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN PLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.61")
CALCULATED VERT. DEFL. (LL) = L/999 (0.17")
ALLOWABLE DEFL. (TL) = L/360 (0.61")
CALCULATED VERT. DEFL. (TL) = L/704 (0.31")

CSI: TC=0.72/1.00 (D-E:1), BC=0.58/1.00 (H-J:1), WB=0.68/1.00 (E-H:1), SS=0.37/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PS) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.90 (H) (INPUT = 0.90)
JSI METAL= 0.85 (H) (INPUT = 1.00)



Structural component only
DWG# T-2006965 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408087	T12	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 08:53:24 2020 Page 2
ID:DMCubINVR6TstFoe31v6l zns1H-6oonUikBBGC5OB56zPRq7EX79FHIZnGXV.OPzNEgv

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	5.0	8.0		Edge
B	TMVW-w	MT20	3.0	8.0		
C	TS-t	MT20	5.0	6.0		
D	TMVWW-t	MT20	5.0	6.0		
E	TMVWW-t	MT20	6.0	16.0	2.75	5.50
G	BMV+p	MT20	3.0	4.0		
H	BMVWW-t	MT20	5.0	6.0	2.25	2.00
I	BS-t	MT20	3.0	6.0		
J	BMVWW-t	MT20	5.0	8.0	2.00	2.00
K	BMV1+p	MT20	3.0	4.0		


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
S	15-1-7	-151	-151	---	BACK	VERT	TOTAL	---	C1
T	17-1-7	-151	-151	---	BACK	VERT	TOTAL	---	C1
U	1-1-7	-72	-72	---	BACK	VERT	TOTAL	---	C1
V	3-1-7	-72	-72	---	BACK	VERT	TOTAL	---	C1
W	5-1-7	-72	-72	---	BACK	VERT	TOTAL	---	C1
X	7-1-7	-72	-72	---	BACK	VERT	TOTAL	---	C1
Y	9-1-7	-72	-72	---	BACK	VERT	TOTAL	---	C1
Z	11-1-7	-72	-72	---	BACK	VERT	TOTAL	---	C1
AA	13-1-7	-72	-72	---	BACK	VERT	TOTAL	---	C1
AB	15-1-7	-72	-72	---	BACK	VERT	TOTAL	---	C1
AC	17-1-7	-72	-72	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

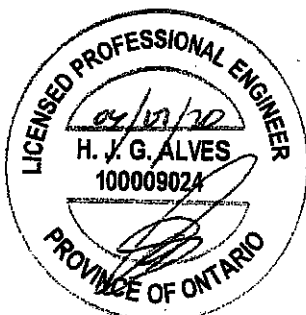

Structural component only
DWG# T-2006965 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408087	T13	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 5 Oct 2019 Mitek Industries, Inc. Sat Apr 25 08:53:24 2020 Page 1
ID:DMCubINVR8TstFoe31v8l_zns11-I_6oonUjKBGCG5OB56zPRq7K57CEHvOnGXV_OPzNEgv

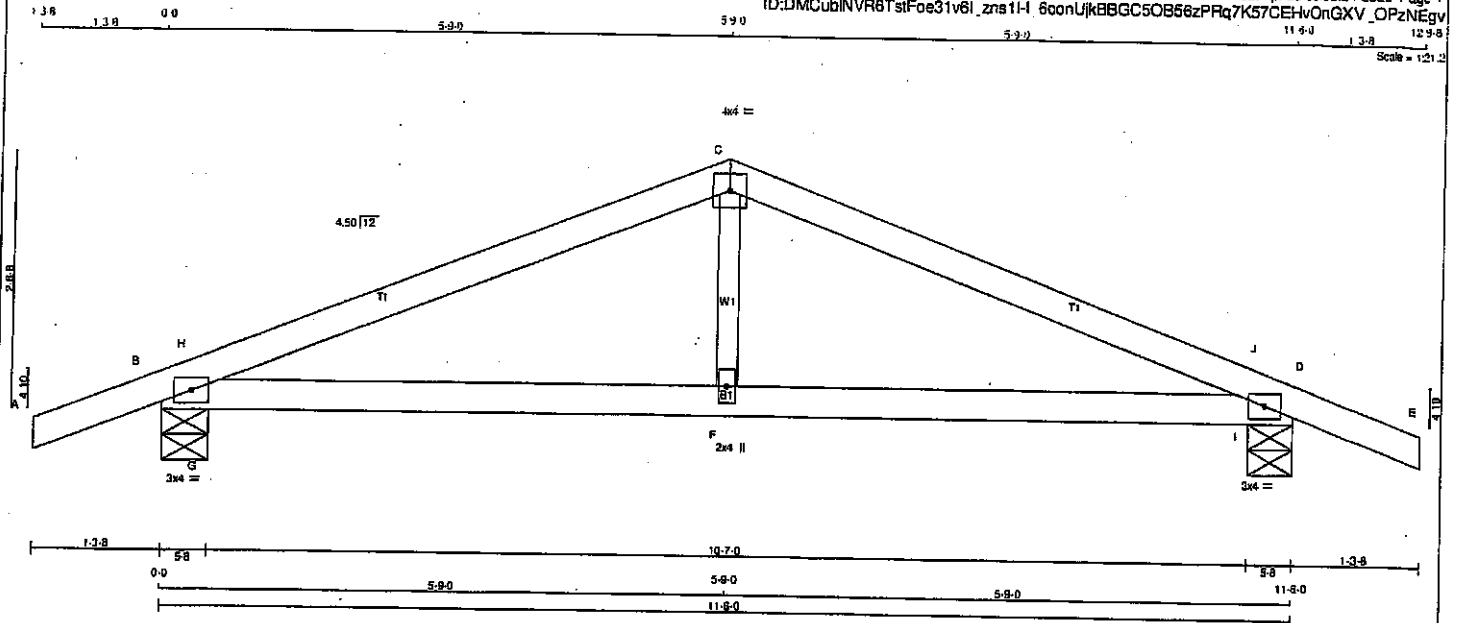

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
B - D	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0		
C	TTW-p	MT20	4.0	4.0		
D	TMB1-I	MT20	3.0	4.0		
F	BMW-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
	VERT	HORZ	DOWN	HORZ
JT	757	0	757	0
B	757	0	757	0
D	757	0	757	0

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
B	533	363/0	0/0	0/0	0/0	170/0	0/0
D	533	363/0	0/0	0/0	0/0	170/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.89 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MAX. UNBRACED LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)
FR-TO		FROM TO			FR-TO		
A-B	0/18	-91.8 -91.8	0.12 (1)	10.00	F-C	0/228	0.05 (4)
B-H	-858/0	-91.8 -91.8	0.15 (1)	6.25	G-H	-435/0	0.00 (1)
H-C	-852/0	-91.8 -91.8	0.36 (1)	5.89	I-J	-435/0	0.00 (1)
C-J	-852/0	-91.8 -91.8	0.36 (1)	5.89			
J-D	-858/0	-91.8 -91.8	0.15 (1)	6.25			
D-E	0/18	-91.8 -91.8	0.12 (1)	10.00			
B-G	0/883	-18.5 -18.5	0.39 (1)	10.00			
G-F	0/883	-18.5 -18.5	0.39 (1)	10.00			
F-I	0/883	-18.5 -18.5	0.39 (1)	10.00			
I-D	0/883	-18.5 -18.5	0.39 (1)	10.00			

TOTAL WEIGHT = 3 X 32 = 96 lb

(MIP)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.38")

CALCULATED VERT. DEFL.(LL) = L/999 (0.04")

ALLOWABLE DEFL.(TL) = L/360 (0.38")

CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CS1: TC=0.36/1.00 (C-H1), BC=0.39/1.00 (B-G:1),

WB=0.05/1.00 (C-F:4), SS=0.33/1.00 (D-I:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.71 (D) (INPUT = 0.90)

JSI METAL= 0.34 (D) (INPUT = 1.00)



Structural component only
DWG# T-2006966

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408087	G13	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:53:10 2020 Page 1					
ID:DMCubINVR6TstFoe31v6l_zns1H-jlGWs?Kx1uQFWxJVGa7luY_EUVY?ai2M6FwDzNEh7					
Scale = 1:21.2					

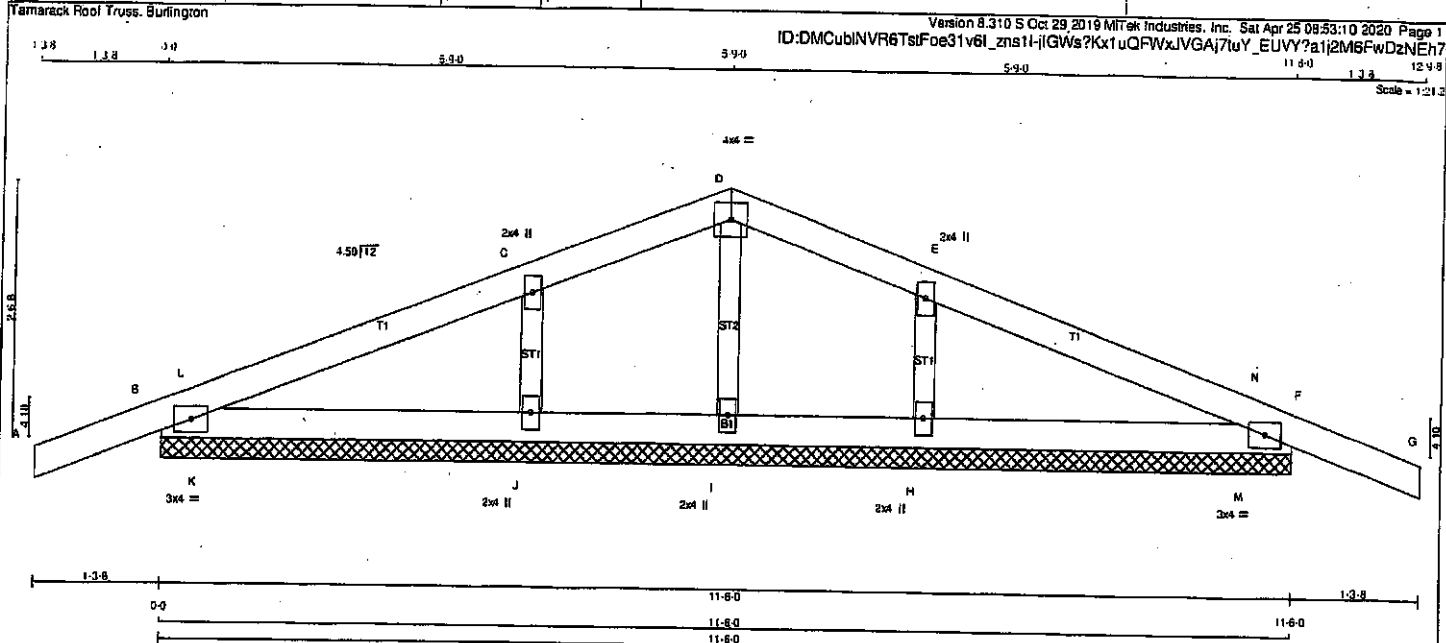

LUMBER				DESIGN CRITERIA	
N. L. G. A. RULES				SPECIFIED LOADS:	
CHORDS	SIZE	DRY	LUMBER	TOP CH. LL	= 25.8 PSF
A - D	2x4	DRY	No.2	BOT CH. LL	= 6.0 PSF
B - F	2x4	DRY	No.2	DL	= 0.0 PSF
ALL WEBS	2x3	DRY	No.2	DL	= 7.4 PSF
ALL GABLE WEBS	2x3	DRY	No.2	TOTAL LOAD	= 39.0 PSF
DRY: SEASONED LUMBER.					

GABLE STUDS SPACED AT 2'-0" O.C.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	
C	TMW+w	MT20	2.0	4.0	
D	TTW-p	MT20	4.0	4.0	
E	TMW+w	MT20	2.0	4.0	
F	TMB1-I	MT20	3.0	4.0	
H, I, J					
H	BMW1+w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/18	-91.8	-91.8 0.12 (1)	10.00	I-D	-47/3	0.01 (1)
B-L	-80/0	-91.8	-91.8 0.02 (4)	6.25	J-C	-314/0	0.05 (1)
L-C	-71/0	-91.8	-91.8 0.13 (1)	6.25	H-E	-314/0	0.05 (1)
C-D	-85/0	-91.8	-91.8 0.13 (1)	6.25	K-L	-142/8	0.00 (1)
D-E	-85/0	-91.8	-91.8 0.13 (1)	6.25	M-N	-142/8	0.00 (1)
E-N	-71/0	-91.8	-91.8 0.13 (1)	6.25			
N-F	-80/0	-91.8	-91.8 0.02 (4)	6.25			
F-G	0/18	-91.8	-91.8 0.12 (1)	10.00			
B-K	0/75	-18.5	-18.5 0.10 (1)	10.00			
K-J	0/75	-18.5	-18.5 0.10 (1)	10.00			
J-I	0/64	-18.5	-18.5 0.07 (1)	10.00			
I-H	0/64	-18.5	-18.5 0.07 (1)	10.00			
H-M	0/75	-18.5	-18.5 0.10 (1)	10.00			
M-F	0/75	-18.5	-18.5 0.10 (1)	10.00			

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 8 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS: TC=0.13/1.00 (E-N:1), BC=0.10/1.00 (H-M:1), WB=0.05/1.00 (E-H:1), SS=0.13/1.00 (E-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PL)	(PL)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.22 (B) (INPUT = 0.90)
JSI METAL= 0.10 (C) (INPUT = 1.00)

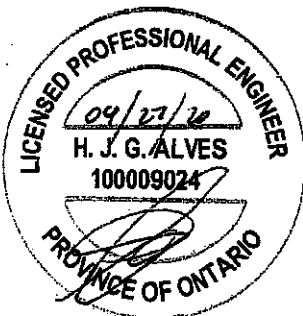

Structural component only
DWG# T-2006948

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ORWG NO.
408087	T14	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Sat Apr 25 08:53:25 2020 Page 1
ID:DMCubINVR6TsiFca31v6l_zns1i-nAgB07VLVVJ7pFyNaqUe_2gPFxU90FZwVBFYwszNEgu

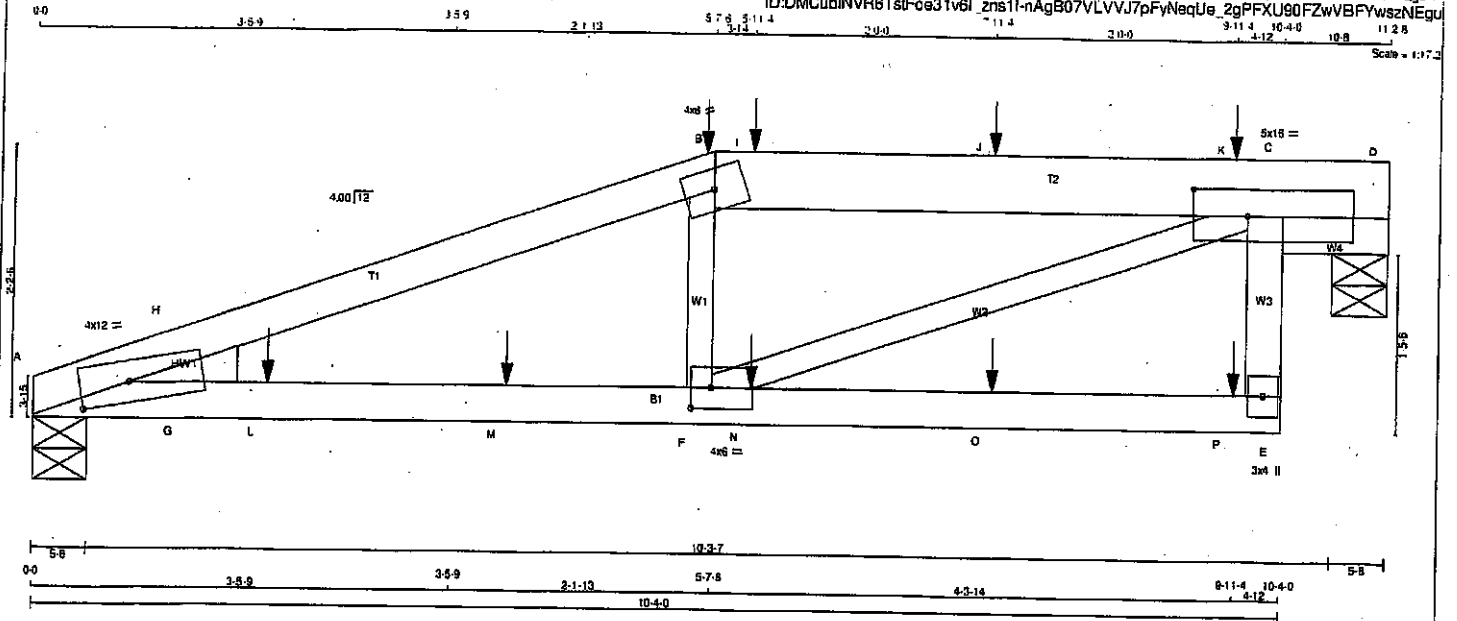

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF
B - D	2x6	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
E - C	2x4	DRY	No.2	SPF
A - E	2x4	DRY	No.2	SPF
ALL WEBS 2x3 DRY No.2 SPF				
DRY: SEASONED LUMBER.				

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	X
A	TMBH1-m	MT20	4.0	12.0	2.00 5.00
B	TTW-h	MT20	4.0	8.0	
C	TMBVW-t	MT20	5.0	16.0	2.50 5.50
E	BMV-p	MT20	3.0	4.0	
F	BMVW-t	MT20	4.0	8.0	2.00 2.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD		HEEL	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	BRG	IN-SX	BRG	IN-SX	WEDGE	
D	1050	0	1050	0	0	5-8	5-8	5-8	5-8	2x4 L	
A	953	0	953	0	0	5-8	5-8	5-8	5-8		

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): D

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	739	506 / 0	0 / 0	0 / 0	0 / 0	233 / 0	0 / 0
A	672	453 / 0	0 / 0	0 / 0	0 / 0	219 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D, A

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.24 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD LC1	MAX. (PLF)	MAX. (LC)	UNBRAC	MEMB.	FORCE (LBS)	MAX. (LBS)	MAX. (LC)
FR-TO		FROM	TO	LENGTH	FR-TO				
A-H	-2013 / 0	-91.8	-91.8 0.13 (1)	4.63	F-B	-409 / 0	0.07 (1)		
H-B	-1976 / 0	-91.8	-91.8 0.45 (1)	4.24	F-C	0 / 2038	0.50 (1)		
B-I	-1905 / 0	-91.8	-91.8 0.72 (1)	4.53	G-H	-146 / 10	0.00 (1)		
I-J	-1905 / 0	-91.8	-91.8 0.72 (1)	4.53					
J-K	-1905 / 0	-91.8	-91.8 0.72 (1)	4.53					
K-C	-1905 / 0	-91.8	-91.8 0.72 (1)	4.53					
C-D	0 / 0	-91.8	-91.8 0.40 (1)	10.00					
E-C	0 / 95	0.0	0.0 0.02 (4)	10.00					
A-G	0 / 1883	-18.5	-18.5 0.66 (1)	10.00					
G-L	0 / 1883	-18.5	-18.5 0.67 (1)	10.00					
L-M	0 / 1883	-18.5	-18.5 0.67 (1)	10.00					
M-F	0 / 1883	-18.5	-18.5 0.67 (1)	10.00					
F-N	0 / 0	-18.5	-18.5 0.22 (1)	10.00					
N-O	0 / 0	-18.5	-18.5 0.22 (1)	10.00					
O-P	0 / 0	-18.5	-18.5 0.22 (1)	10.00					
P-E	0 / 0	-18.5	-18.5 0.22 (1)	10.00					

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
B	5-7-6	-45	-50	FRONT	VERT	DEAD		C1
B	5-7-6	-237	-237	FRONT	VERT	SNOW		C1
I	5-11-4	-103	-103	BACK	VERT	TOTAL		C1
J	7-11-4	-72	-72	BACK	VERT	TOTAL		C1
K	9-11-4	-72	-72	BACK	VERT	TOTAL		C1
L	1-11-4	-50	-50	BACK	VERT	TOTAL		C1
M	3-11-4	-50	-50	BACK	VERT	TOTAL		C1
N	5-11-4	-50	-50	BACK	VERT	TOTAL		C1
O	7-11-4	-50	-50	BACK	VERT	TOTAL		C1
P	9-11-4	-55	-55	BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.34")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (0.34")
CALCULATED VERT. DEFL.(TL) = L/677 (0.18")

CSI: TC=0.72/1.00 (B-C:1), BC=0.67/1.00 (F-G:1),
WB=0.50/1.00 (C-F:1), SS=0.43/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.86 (F) (INPUT = 0.90)

JSI METAL = 0.47 (F) (INPUT = 1.00)



Structural component only
DWG# T-2006967

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ORWG NO.
408087	T15	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 08:53:26 2020 Page 1	

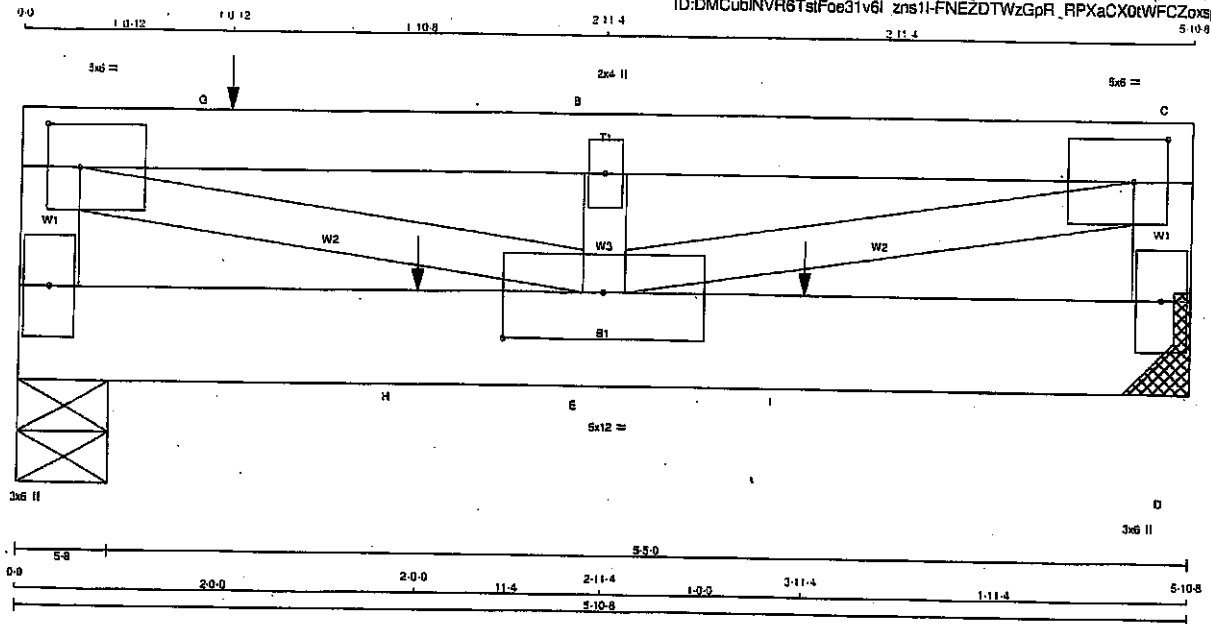

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
F - A	2x4	DRY	No.2	SPF		
A - C	2x4	DRY	No.2	SPF		
D - C	2x4	DRY	No.2	SPF		
F - D	2x6	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
DRY: SEASONED LUMBER.						

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F - A	12	TOP
A - C	12	SIDE(0.0)
C - D	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D	12	SIDE(14.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	12	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	5.0	5.0	2.50	2.00
B	TMVW-w	MT20	2.0	4.0		
C	TMVW-t	MT20	5.0	5.0	2.50	2.00
D	BMVW-t	MT20	3.0	6.0		
E	BMVW-w	MT20	5.0	12.0	2.75	6.00
F	BMVW-t	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORZ	UPLIFT
F	3277	0	0	0
D	2358	0	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4'-0".

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED
F	2323 1495 / 0 0 / 0 0 / 0 0 / 0 0 / 0 0
D	1673 1070 / 0 0 / 0 0 / 0 0 / 0 0 / 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.00 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO		FR-TO		
F-A	-2531 / 0	0.0	0.0 0.14 (1)	A-E	0 / 5214	0.85 (1)
A-G	-4958 / 0	-91.8	-91.8 0.80 (1)	E-B	-799 / 0	0.06 (1)
G-B	-4958 / 0	-91.8	-91.8 0.80 (1)	E-C	0 / 5214	0.65 (1)
B-C	-4958 / 0	-91.8	-91.8 0.18 (1)			
D-C	-1717 / 0	0.0	0.0 0.09 (1)			
F-H	0 / 0	-43.5	-43.5 0.52 (1)			
H-E	0 / 0	-43.5	-43.5 0.52 (1)			
E-I	0 / 0	-43.5	-43.5 0.43 (1)			
I-D	0 / 0	-43.5	-43.5 0.43 (1)			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
G	1-0-12	-1275	-1275	---	BACK	VERT	TOTAL	C1
H	2-0-0	-2000	-2000	---	BACK	VERT	TOTAL	C1
I	3-11-4	-1566	-1566	---	BACK	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 23 = 47 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/822 (0.09")

CSI: TC=0.80/1.00 (A-B:1), BC=0.52/1.00 (E-F:1), WB=0.65/1.00 (A-E:1), SS=0.48/1.00 (E-F:1)

DCL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.87 (A) (INPUT = 0.90)
JSI METAL = 0.62 (C) (INPUT = 1.00)



Structural component only
DWG# T-2006968

JOB NAME 408088	TRUSS NAME T20	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:03:31 2020 Page 2
ID:DMCub/NVR6TstFoe31v6I zns1I-1mIHCKrTnhf8WNI+r85MIXrm boOu?Mu7sT2cCkzNEXC

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.50	3.00
C	TTW-m	MT20	4.0	4.0		
D	TTW-m	MT20	4.0	8.0		
E	TTW-m	MT20	5.0	8.0	2.00	2.75
F	TMV-p	MT20	3.0	4.0		
G	TTW-m	MT20	5.0	8.0	2.00	3.00
H	TMVW-t	MT20	5.0	8.0	2.50	1.75
I	BMV1-p	MT20	3.0	6.0		
J	BMVW-t	MT20	5.0	6.0		
K	BVMWW-t	MT20	8.0	12.0	4.50	4.50
L	BMV-p	MT20	3.0	6.0		
M	BMVW-t	MT20	8.0	9.0		
N	BS-t	MT20	5.0	6.0		
O	BMVW-t	MT20	5.0	8.0		
P	BMV1-p	MT20	3.0	6.0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LG1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
W	17-11-4	-8	-8	---	FRONT	VERT	TOTAL	---	C1
X	19-11-4	-8	-8	---	FRONT	VERT	TOTAL	---	C1
Y	21-11-4	-8	-8	---	FRONT	VERT	TOTAL	---	C1
Z	23-11-4	-8	-8	---	FRONT	VERT	TOTAL	---	C1
AA	25-11-4	-8	-8	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

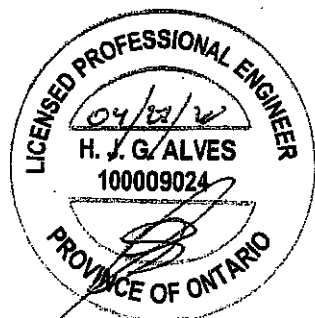

Structural component only
DWG# T-2006976

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408088	T21	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 08:03:32 2020 Page 1
 ID:DMCubINVR6TstFos31v61_zns11-VyrtPgr5Y?n?8Xs2ipt 42IDmDkCkhzH47nAkAzNEXP
 Scale = 1:43.5

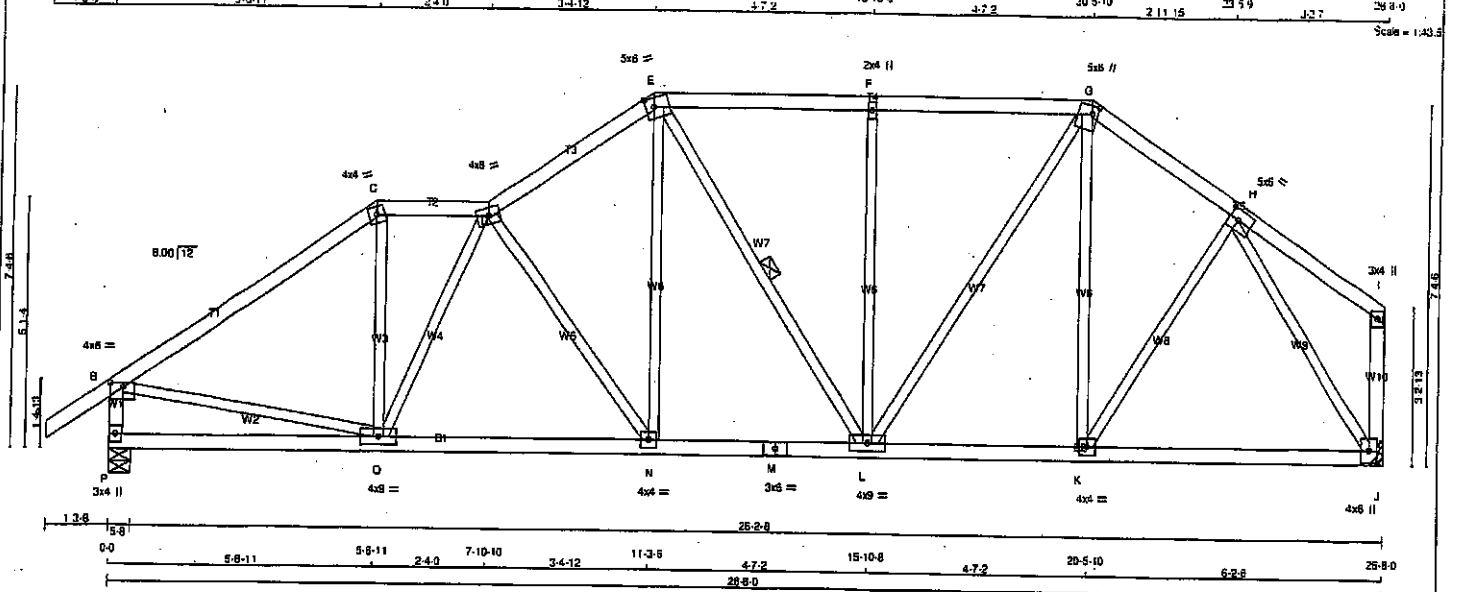

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
J - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	4.0	6.0	1.00 3.25
C	TTW-m	MT20	4.0	4.0	
D	TTW-m	MT20	4.0	4.0	
E	TTW-m	MT20	5.0	6.0	2.25 2.00
F	TMVW-p	MT20	2.0	4.0	
G	TTW-m	MT20	5.0	8.0	2.00 1.50
H	TMVW-p	MT20	5.0	6.0	2.50 2.25
I	TMVW-p	MT20	3.0	4.0	
J	BMVW1-p	MT20	4.0	6.0	
K	BMVW1-p	MT20	4.0	4.0	
L	BMVW1-p	MT20	4.0	4.0	
M	BS-t	MT20	3.0	6.0	
N	BMVW1-p	MT20	4.0	4.0	
O	BMVW1-p	MT20	4.0	4.0	
P	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	
P	1596 0	1596 0	5-8	5-8	
J	1470 0	1470 0	MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
P	1126	752 / 0	0 / 0	0 / 0	0 / 0
J	1040	682 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.72 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)					
CHORDS			WEBS		
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM	FR-TO		
A-B	0 / 35	-91.8	-91.8	0 / 552	0.12 (1)
B-C	-1642 / 0	-91.8	-91.8	0 / 552	0.35 (1)
C-D	-1383 / 0	-91.8	-91.8	0 / 552	0.13 (1)
D-E	-1625 / 0	-91.8	-91.8	0 / 552	0.00 (4)
E-F	-1389 / 0	-91.8	-91.8	0 / 552	0.49 (1)
F-G	-1389 / 0	-91.8	-91.8	0 / 552	0.18 (1)
G-H	-1228 / 0	-91.8	-91.8	0 / 552	0.18 (1)
H-I	0 / 17	-91.8	-91.8	0 / 552	0.08 (1)
P-B	-1552 / 0	0.0	0.0	0 / 552	0.31 (1)
J-I	-110 / 0	0.0	0.0	0 / 552	0.88 (1)
P-O	0 / 0	-18.5	-18.5	0 / 552	0.38 (1)
O-N	0 / 1697	-18.5	-18.5	0 / 552	10.00
N-M	0 / 1361	-18.5	-18.5	0 / 552	10.00
M-L	0 / 1361	-18.5	-18.5	0 / 552	10.00
L-K	0 / 1001	-18.5	-18.5	0 / 552	10.00
K-J	0 / 813	-18.5	-18.5	0 / 552	10.00

TOTAL WEIGHT = 126 lb

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.8 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF
SPACING	= 24.0 IN. OC

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.89")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
 ALLOWABLE DEFL.(TL) = L/360 (0.89")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.42/1.00 (B-C-1), BC=0.34/1.00 (N-O-1), WB=0.88/1.00 (H-J-1), SS=0.20/1.00 (F-G-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE GRIP (DRY)	SHEAR	SECTION	(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN			
MT20	618	354	1667	788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (H) (INPUT = 0.90)
 JSI METAL = 0.44 (M) (INPUT = 1.00)

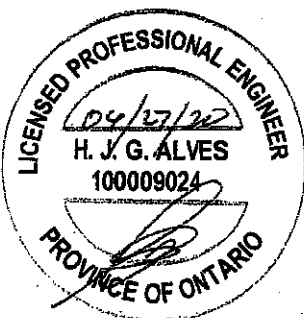

Structural component only
 DWG# T-2006977

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408088	T22	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 5 Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 09:03:33 2020 Page 1
ID:DMCubINVR6TslFoe3Iv6l_zns1l-z8P1d0sJlvsmhREGWPDdGrMzd5YTlsQJnXjHczNEXO

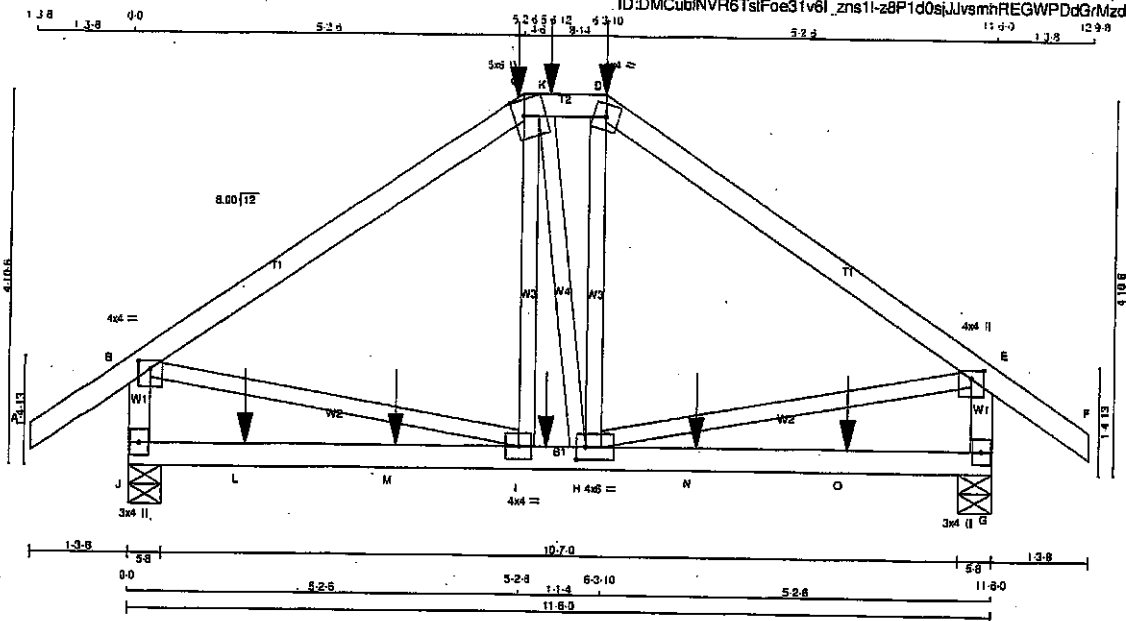

TOTAL WEIGHT = 53 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - D	2x4	DRY	No.2	SPF		
D - F	2x4	DRY	No.2	SPF		
J - B	2x4	DRY	No.2	SPF		
G - E	2x4	DRY	No.2	SPF		
J - G	2x4	DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	4.0	1.25	2.00
C	TTWW-m	MT20	5.0	5.0	2.50	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMVW-p	MT20	4.0	4.0	1.25	2.00
G	BMV1-p	MT20	3.0	4.0		
H	BMVWW-t	MT20	4.0	5.0	2.00	1.50
I	BMVWW-t	MT20	4.0	4.0		
J	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	VERT	HORZ	MAXIMUM FACTORED GROSS REACTION	DOWN	HORZ	INPUT BRG	REQD BRG
JT								
J	1103	0	1103	0	0	0	5-8	5-8
G	1095	0	1095	0	0	0	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	776	531/0	0/0	0/0	0/0	245/0	0/0
G	771	529/0	0/0	0/0	0/0	242/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.57 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED HORIZ. LOAD (LBS)	MAX. FACTORED FORCE (LBS)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED HORIZ. LOAD (LBS)
FR-TO						FR-TO				
A-B	0/35	-91.8	-91.8	0.14 (1)	10.00	I-C	-59/56	0.02 (1)		
B-C	-943/0	-91.8	-91.8	0.52 (1)	5.57	C-H	-23/0	0.01 (1)		
C-K	-778/0	-91.8	-91.8	0.07 (1)	6.25	H-D	-41/63	0.02 (4)		
K-D	-778/0	-91.8	-91.8	0.07 (1)	6.25	B-I	0/800	0.20 (1)		
D-E	-939/0	-91.8	-91.8	0.52 (1)	5.58	H-E	0/798	0.20 (1)		
E-F	0/35	-91.8	-91.8	0.14 (1)	10.00					
J-B	-1049/0	0.0	0.0	0.12 (1)	7.64					
G-E	-1042/0	0.0	0.0	0.12 (1)	7.67					
J-L	0/0	-18.5	-18.5	0.19 (4)	10.00					
L-M	0/0	-18.5	-18.5	0.19 (4)	10.00					
M-I	0/0	-18.5	-18.5	0.19 (4)	10.00					
I-H	0/783	-18.5	-18.5	0.27 (4)	10.00					
H-N	0/0	-18.5	-18.5	0.20 (4)	10.00					
N-O	0/0	-18.5	-18.5	0.20 (4)	10.00					
O-G	0/0	-18.5	-18.5	0.20 (4)	10.00					

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	5-2-6	-38	-42	FRONT	VERT	DEAD	---	C1
C	5-2-6	-195	-195	FRONT	VERT	SNOW	---	C1
D	6-3-10	-38	-42	FRONT	VERT	DEAD	---	C1
D	6-3-10	-195	-195	FRONT	VERT	SNOW	---	C1
I	5-6-12	-17	-17	BACK	VERT	TOTAL	---	C1
K	5-6-12	-127	-127	BACK	VERT	TOTAL	---	C1
L	1-6-12	-17	-17	BACK	VERT	TOTAL	---	C1
M	3-8-12	-17	-17	BACK	VERT	TOTAL	---	C1
N	7-6-12	-17	-17	BACK	VERT	TOTAL	---	C1
O	9-6-12	-17	-17	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/980 (0.38")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/960 (0.38")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.52/1.00 (B-C:1), BC=0.27/1.00 (H-I:4), WB=0.20/1.00 (B-I:1), SSI=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 L.S BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES	PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.80 (1) INPUT = 0.80 ;
JSI METAL= 0.31 (8) INPUT = 1.00 ;

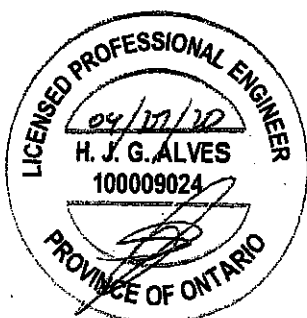

Structural component only
DWG# T-2006978

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408088	T23	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 09:03:34 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_znst1-RLzPqML4c1JNr0QqDwS9TOZi0TicnRZYRGp3zNEXN

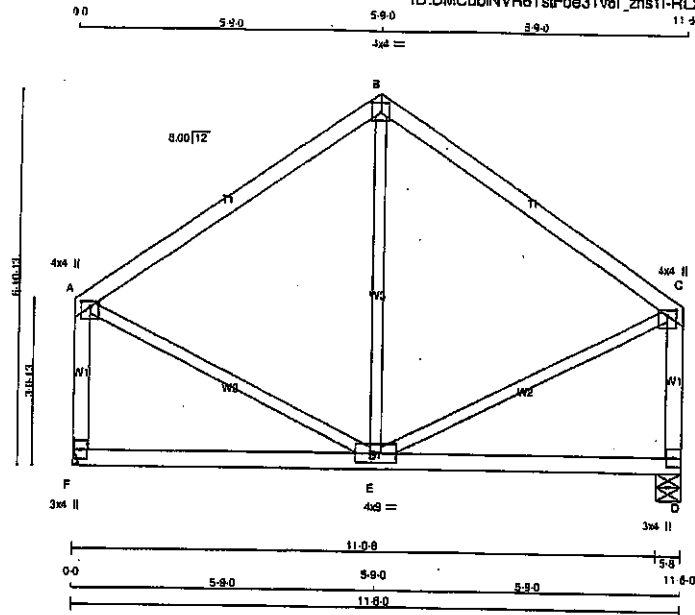

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
A - B	2x4	DRY	No.2	SPF
B - C	2x4	DRY	No.2	SPF
F - A	2x4	DRY	No.2	SPF
F - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS 2x3 DRY No.2 SPF				
EXCEPT				
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW+p	MT20	4.0	4.0	1.25 2.00
B	TTW+p	MT20	4.0	4.0	2.25 2.00
C	TMVW+p	MT20	4.0	4.0	1.25 2.00
D	BMV1+p	MT20	3.0	4.0	
E	BMVWW-t	MT20	4.0	9.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	HORZ	GROSS REACTION	GROSS REACTION	DOWN	UP	BRG	IN-SX	IN-SX
F	634	0	634	0	0	0	5-8	5-8	
D	634	0	634	0	0	0	5-8	5-8	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	448	294 / 0	0 / 0	0 / 0	0 / 0	154 / 0	0 / 0
D	448	294 / 0	0 / 0	0 / 0	0 / 0	154 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WESS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRACED LENGTH	MEMB.	FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO		FR-TO		
A-B	-346 / 0	-91.8	-91.8	0.39 (1)	E-B	-144 / 46	0.11 (1)
B-C	-346 / 0	-91.8	-91.8	0.39 (1)	A-E	0 / 319	0.07 (1)
F-A	-593 / 0	0.0	0.0	0.10 (1)	E-C	0 / 319	0.07 (1)
D-C	-593 / 0	0.0	0.0	0.10 (1)			
F-E	0 / 0	-18.5	-18.5	0.18 (4)			
E-D	0 / 0	-18.5	-18.5	0.18 (4)			

TOTAL WEIGHT = 2 X 50 = 100 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.38")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.38")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CSI: TC=0.39/1.00 (B-C:1), BC=0.18/1.00 (D-E:4), WB=0.11/1.00 (B-E:1), SS=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1667 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.41 (A) (INPUT = 0.50)
JSI METAL= 0.12 (A) (INPUT = 1.00)



Structural component only
DWG# T-2006979

DRWG NO.

Source: 1:25.2



JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	5.0	6.0	2.50	2.50
B	TMVW-4v	MT20	3.0	6.0		
C	TMVW-1	MT20	5.0	6.0	2.50	2.50
D	BMV1-p	MT20	3.0	6.0		
E	BMVWVW-1	MT20	5.0	12.0		
F	BMV1+0	MT20	3.0	6.0		

1 C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

SI GRIP = 0.90 (A) (INPUT = 0.90)
SI METAL = 0.41 (C) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408089	T30	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:25:40 2020 Page 2

ID:DMCubINVR6TstFoe31v6I zns1I-dR5h7mw5o15aScOGviiPv5J4SYwwwK4ISkTRLczNEC

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-I	MT20	5.0	8.0		
C	TTW-m	MT20	4.0	6.0		
D	TMVWW-I	MT20	4.0	9.0		
E	TMVW-w	MT20	2.0	4.0		
F	TS-I	MT20	3.0	6.0		
G	TMVWW-I	MT20	4.0	9.0		
H	TTW-m	MT20	4.0	8.0		
I	TMVW-I	MT20	5.0	8.0		
K	BMV-I-p	MT20	3.0	6.0		
L	BMVWW-I	MT20	6.0	9.0	3.00	2.75
M	BMVW-w	MT20	3.0	8.0		
N	BS-I	MT20	5.0	6.0		
O	BMVWW-I	MT20	5.0	8.0		
P	BS-I	MT20	5.0	6.0		
Q	BMVW-w	MT20	3.0	6.0		
R	BMVWW-I	MT20	6.0	9.0	3.00	3.75
S	BMV-I-p	MT20	3.0	6.0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-15	-428	-428		FRONT	VERT	TOTAL		C1
D	11-11-3	-110	-110		FRONT	VERT	TOTAL		C1
E	17-7-0	-110	-110		FRONT	VERT	TOTAL		C1
G	28-2-13	-110	-110		FRONT	VERT	TOTAL		C1
H	29-3-1	-428	-428		FRONT	VERT	TOTAL		C1
M	23-2-13	-26	-26		FRONT	VERT	TOTAL		C1
N	21-2-13	-26	-26		FRONT	VERT	TOTAL		C1
O	17-7-0	-26	-26		FRONT	VERT	TOTAL		C1
P	13-11-3	-26	-26		FRONT	VERT	TOTAL		C1
Q	11-11-3	-26	-26		FRONT	VERT	TOTAL		C1
T	7-11-3	-110	-110		FRONT	VERT	TOTAL		C1
U	9-11-3	-110	-110		FRONT	VERT	TOTAL		C1
V	13-11-3	-110	-110		FRONT	VERT	TOTAL		C1
W	15-11-3	-110	-110		FRONT	VERT	TOTAL		C1
X	19-2-13	-110	-110		FRONT	VERT	TOTAL		C1
Y	21-2-13	-110	-110		FRONT	VERT	TOTAL		C1
Z	25-2-13	-110	-110		FRONT	VERT	TOTAL		C1
AA	27-2-13	-110	-110		FRONT	VERT	TOTAL		C1
AB	1-11-4	-26	-26		FRONT	VERT	TOTAL		C1
AC	3-11-4	-26	-26		FRONT	VERT	TOTAL		C1
AD	5-11-3	-26	-26		FRONT	VERT	TOTAL		C1
AE	7-11-3	-26	-26		FRONT	VERT	TOTAL		C1
AF	9-11-3	-26	-26		FRONT	VERT	TOTAL		C1
AG	15-11-3	-26	-26		FRONT	VERT	TOTAL		C1
AH	19-2-13	-26	-26		FRONT	VERT	TOTAL		C1
AI	25-2-13	-26	-26		FRONT	VERT	TOTAL		C1
AJ	27-2-13	-26	-26		FRONT	VERT	TOTAL		C1
AK	29-2-13	-26	-26		FRONT	VERT	TOTAL		C1
AL	31-2-12	-26	-26		FRONT	VERT	TOTAL		C1
AM	33-2-12	-26	-26		FRONT	VERT	TOTAL		C1


CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

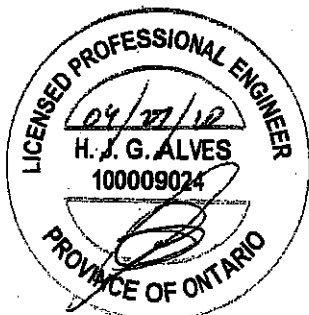

Structural component only
DWG# T-2006996 2/2

Version 8.310 S Oct 29 2019 Mirak Industries, Inc. Sat Apr 25 09:25:41 2020 Page 1
 ID:DMCubINVR6TstFoe31v6I_zns1t-5ef4L6xIZKQD4mZT3QDeRlrEzxFsdkeuhOD?uazNECe
 1:38 0.0 3.0 3.0 2.10 5.10 5.10 15.4 11.8 5.3 2 12.2 10 5.4 5 17.7 0 5.4 22.1 0 5.4 2 29.3 8 2.10 0 32.1 8 24.8 35.2 0 36.9 8 5.4 1.1 8
 Scale = 1:57.0

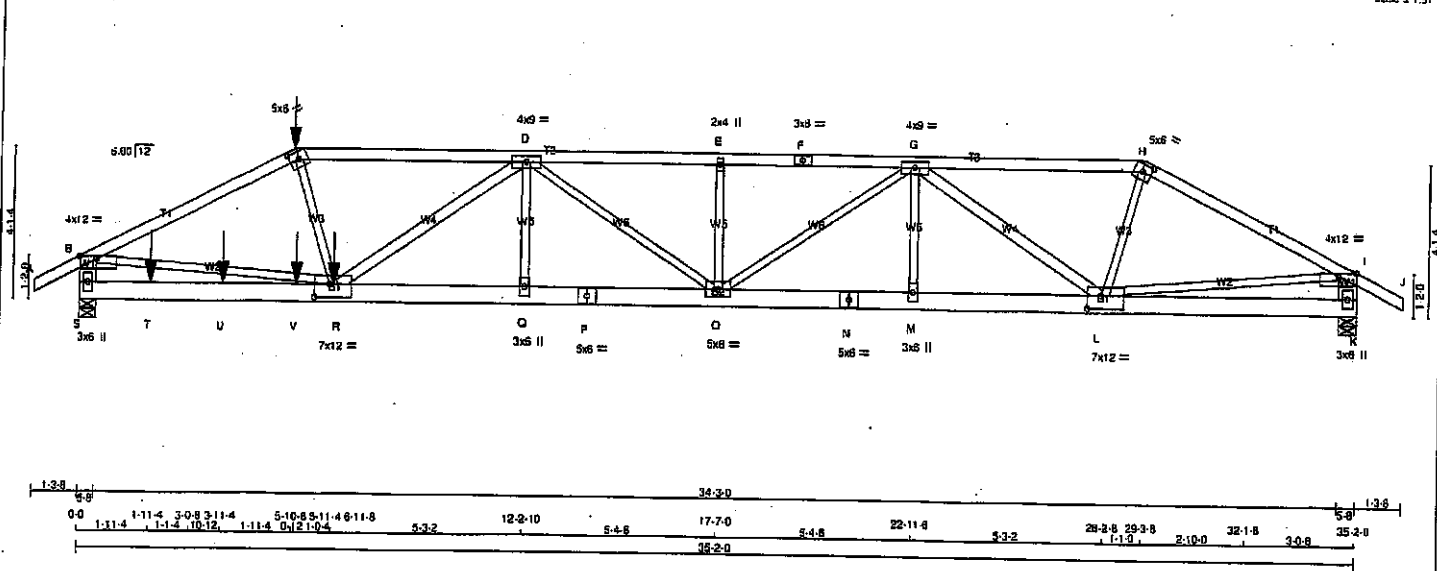

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF
S - B	2x6	DRY	No.2	SPF
K - I	2x6	DRY	No.2	SPF
S - P	2x6	DRY	No.2	SPF
P - N	2x6	DRY	No.2	SPF
N - K	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
R - D	2x4	DRY	No.2	SPF
G - L	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE(0.0)
C - F	12	SIDE(0.0)
F - H	12	TOP
H - J	12	TOP
S - B	12	TOP
K - I	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
S - P	12	SIDE(0.0)
P - N	12	TOP
N - K	12	TOP
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	6	
2x4	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT 4929 0	DOWN 4929 0	0 0	5-8
K	VERT 2760 0	DOWN 2760 0	0 0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX/MIN COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
S	3479 2322/0 0/0 0/0 0/0 1157/0 0/0
K	1948 1302/0 0/0 0/0 0/0 646/0 0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.93 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FORCE (LBS)
FR-TO				FR-TO	
A-B	0/28	-91.8	-91.8 0.07 (1)	M-G	0/124
B-C	-8095/0	-91.8	-91.8 0.83 (1)	Q-D	0/145
C-D	-8090/0	-91.8	-91.8 0.75 (1)	O-G	0/1623
D-E	-7855/0	-91.8	-91.8 0.92 (1)	D-O	-810/0
E-F	-7855/0	-91.8	-91.8 0.63 (1)	O-E	-406/0
F-G	-7855/0	-91.8	-91.8 0.41 (1)	C-R	0/2815
G-H	-4203/0	-91.8	-91.8 0.45 (1)	B-R	0/7283
H-I	-4212/0	-91.8	-91.8 0.45 (1)	R-D	-531/0
I-J	0/28	-91.8	-91.8 0.07 (1)	L-H	0/1446
S-B	-4807/0	0.0	0.0 0.17 (1)	L-I	0/3789
K-I	-2691/0	0.0	0.0 0.09 (1)	G-L	-2867/0
S-T	0/0	-18.5	-18.5 0.11 (4)		
T-U	0/0	-18.5	-18.5 0.11 (4)		
U-V	0/0	-18.5	-18.5 0.11 (4)		
V-R	0/0	-18.5	-18.5 0.11 (4)		
R-Q	0/8520	-18.5	-18.5 0.62 (1)		
Q-P	0/8520	-18.5	-18.5 0.61 (1)		
P-O	0/8520	-18.5	-18.5 0.61 (1)		
O-N	0/8522	-18.5	-18.5 0.48 (1)		
N-M	0/8522	-18.5	-18.5 0.48 (1)		
M-L	0/8522	-18.5	-18.5 0.45 (1)		
L-K	0/0	-18.5	-18.5 0.08 (4)		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-15	-428	-428	---	BACK	VERT	TOTAL	---	C1
R	6-11-8	-3058	-3058	---	BACK	VERT	TOTAL	---	C1
T	1-11-4	-25	-25	---	BACK	VERT	TOTAL	---	C1
U	3-11-4	-25	-25	---	BACK	VERT	TOTAL	---	C1
V	5-11-4	-25	-25	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF SCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')

CALCULATED VERT. DEFL.(LL) = U/999 (0.25')

ALLOWABLE DEFL.(TL) = L/360 (1.17')

CALCULATED VERT. DEFL.(TL) = U/913 (0.46')

CSI: TC=0.83/1.00 (B-C:1), BC=0.62/1.00 (Q-R:1), WB=0.90/1.00 (B-R:1), SS=0.15/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 618 354 1867 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (R) (INPUT = 0.90)

JSI METAL= 0.77 (P) (INPUT = 1.00)

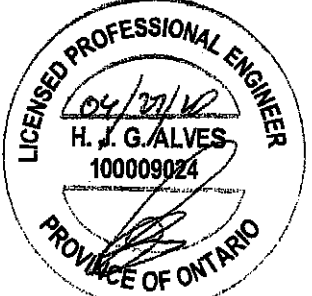

Structural component only
 DWG# T-2006997 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408089	T30Z	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington


Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 09:25:41 2020 Page 2
ID:DMCubINVR6TstF0e31v6I zns11-5ef4L6xZKQD4mzT3QDeRjEzxFsdkeuhOD?uezNECe

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	12.0	1.00	5.50
C	TTW-h	MT20	5.0	6.0	2.50	3.00
D	TMWWVW-t	MT20	4.0	9.0		
E	TMW-w	MT20	2.0	4.0		
F	TS-1	MT20	3.0	6.0		
G	TMWWVW-t	MT20	4.0	9.0		
H	TTW-h	MT20	5.0	6.0	2.50	3.00
I	TMVW-p	MT20	4.0	12.0	1.00	5.50
K	BMV1-p	MT20	3.0	6.0		
L	BMWWVW-t	MT20	7.0	12.0	4.25	4.50
M	BMW-w	MT20	3.0	6.0		
N	BS-1	MT20	5.0	6.0		
O	BMWWVW-t	MT20	5.0	8.0		
P	BS-1	MT20	5.0	6.0		
Q	BMW-w	MT20	3.0	6.0		
R	BMWWVW-t	MT20	7.0	12.0	4.25	5.00
S	BMV1-p	MT20	3.0	6.0		



Structural component only
DWG# T-2006997 3/2

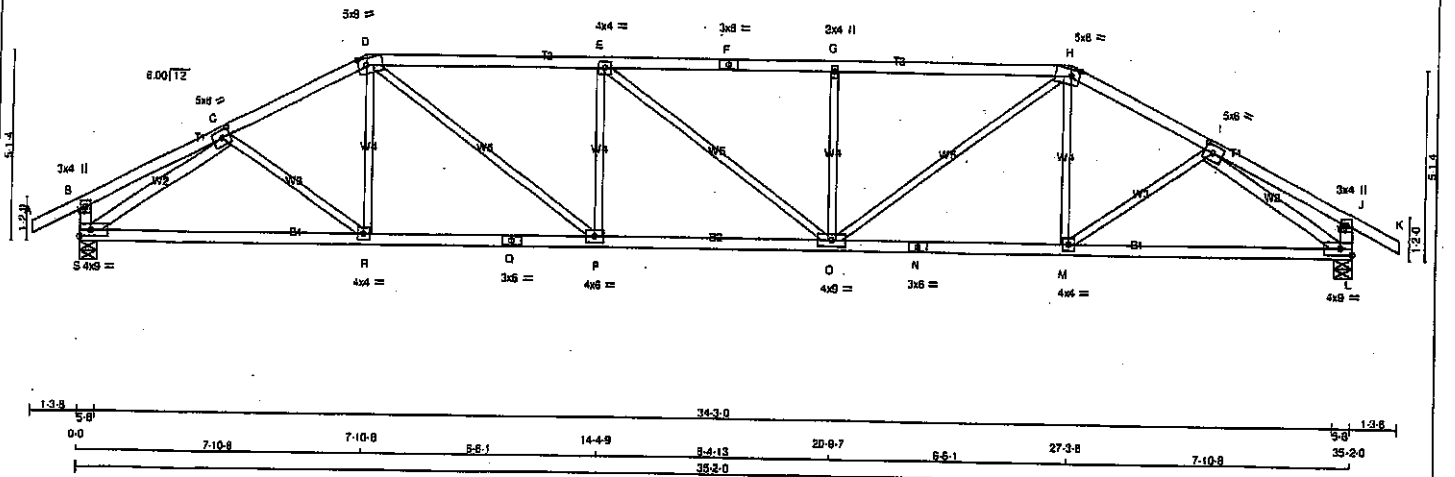

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
O - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2

ALL WEBS EXCEPT

CHORDS	SIZE	LUMBER	DESCR.
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0	
C	TMVW-t	MT20	5.0	8.0	2.50 2.75
D	TTWV-m	MT20	5.0	8.0	2.25 2.75
E	TMVW-t	MT20	4.0	4.0	
F	TS-t	MT20	3.0	6.0	
G	TMVW-t	MT20	2.0	4.0	
H	TTWV-m	MT20	5.0	8.0	2.25 2.75
I	TMVW-t	MT20	5.0	8.0	2.50 2.75
J	TMV-p	MT20	3.0	4.0	
L	BMVW-t	MT20	4.0	9.0	Edge
M	BMVW-t	MT20	4.0	4.0	
N	BS-t	MT20	3.0	6.0	
O	BMVW-t	MT20	4.0	9.0	
P	BMVW-t	MT20	4.0	6.0	
Q	BS-t	MT20	3.0	6.0	
R	BMVW-t	MT20	4.0	4.0	
S	BMVW-t	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	0	0
S	2063	0	0	5-8
L	2063	0	0	5-8

UNFACTORED REACTIONS

	1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
S	1457	969 / 0 0 / 0 0 / 0 0 / 0 488 / 0 0 / 0
L	1457	969 / 0 0 / 0 0 / 0 0 / 0 488 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.94 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO					FR-TO		
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	C-R	0 / 93	0.03 (4)
B-C	0 / 16	-91.8	-91.8 0.20 (1)	10.00	R-D	0 / 121	0.04 (4)
C-D	-2799 / 0	-91.8	-91.8 0.32 (1)	3.88	D-P	0 / 1267	0.29 (1)
D-E	-3508 / 0	-91.8	-91.8 0.95 (1)	2.94	P-E	-843 / 0	0.25 (1)
E-F	-3507 / 0	-91.8	-91.8 0.93 (1)	2.94	E-O	-2 / 0	0.00 (1)
F-G	-3507 / 0	-91.8	-91.8 0.93 (1)	2.94	O-G	-843 / 0	0.25 (1)
G-H	-3507 / 0	-91.8	-91.8 0.94 (1)	2.95	H-O	0 / 1266	0.28 (1)
H-I	-2799 / 0	-91.8	-91.8 0.32 (1)	3.88	M-I	0 / 121	0.04 (4)
I-J	0 / 16	-91.8	-91.8 0.20 (1)	10.00	M-L	0 / 93	0.03 (4)
J-K	0 / 28	-91.8	-91.8 0.12 (1)	10.00	S-C	-2974 / 0	0.83 (1)
S-B	-270 / 0	0.0	0.0 0.03 (1)	7.81	I-L	-2974 / 0	0.83 (1)
L-J	-270 / 0	0.0	0.0 0.03 (1)	7.81			
S-R	0 / 2417	-18.5	-18.5 0.53 (1)	10.00			
R-Q	0 / 2489	-18.5	-18.5 0.54 (1)	10.00			
Q-P	0 / 2489	-18.5	-18.5 0.54 (1)	10.00			
P-O	0 / 3508	-18.5	-18.5 0.94 (1)	10.00			
O-N	0 / 2489	-18.5	-18.5 0.54 (1)	10.00			
N-M	0 / 2489	-18.5	-18.5 0.54 (1)	10.00			
M-L	0 / 2417	-18.5	-18.5 0.53 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF

BOT CH. LL = 0.0 PSF
DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17)
CALCULATED VERT. DEFL. (LL) = L/999 (0.21)
ALLOWABLE DEFL. (TL) = L/360 (1.17)
CALCULATED VERT. DEFL. (TL) = L/999 (0.41)

CSI: TC=0.86/1.00 (D-E-1), BC=0.84/1.00 (O-P-1), WB=0.83/1.00 (I-L-1), SS=0.28/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PL)
MT20	618	354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (I) (INPUT = 0.90)
JSI METAL = 0.77 (N) (INPUT = 1.00)




Structural component only
DWG# T-2006998

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408089	T32	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:25:43 2020 Page 1
ID:DMCubINVR6TstFoe31vbl zns11-10nqloy 5yU8J46rArG6WoxAlz25i6BBii5yXzNECc

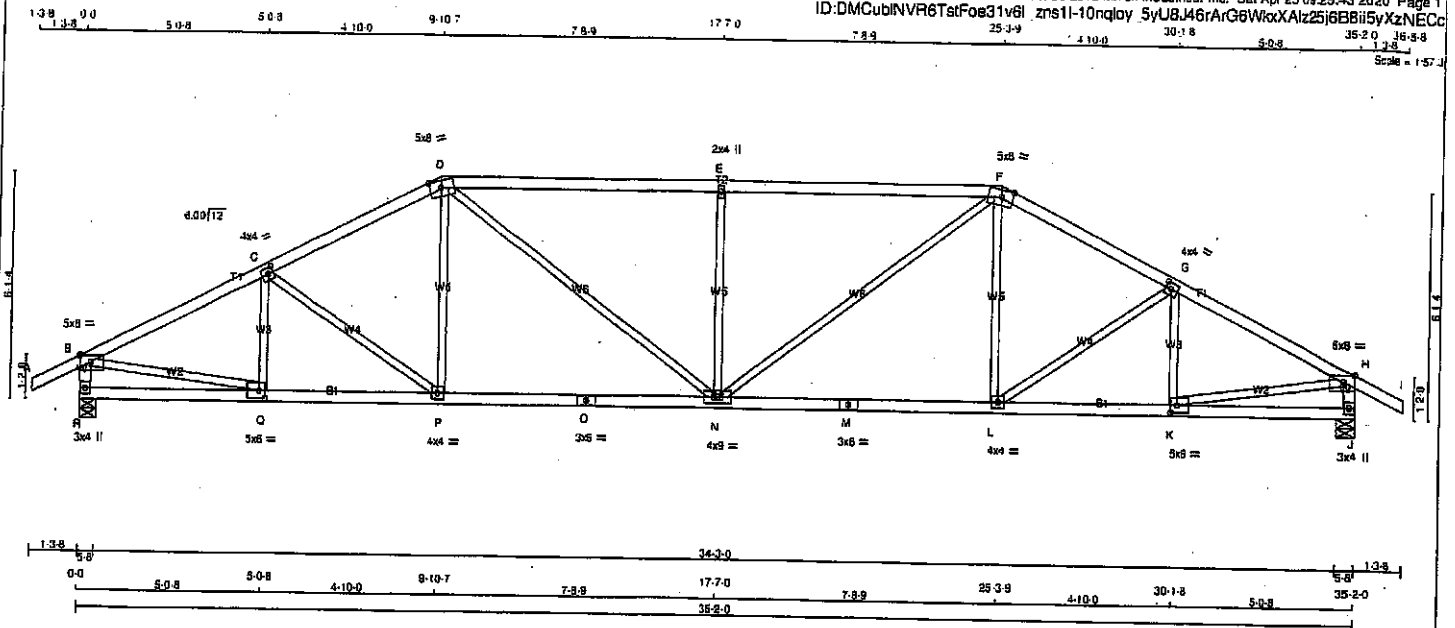

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY				TOTAL WEIGHT = 2 X 139 = 277 lb			
N. L. G. A. RULES				BUILDING DESIGNER							
CHORDS				BEARINGS							

CHORDS	SIZE	DRY	DESCR.	FACTORED	MAXIMUM FACTORED	INPUT	REQD
A - D	2x4	DRY	No.2	SPF	GROSS REACTION	GROSS REACTION	BRG
O - F	2x4	DRY	No.2	SPF	JT VERT	JT VERT	BRG
F - I	2x4	DRY	No.2	SPF	R HORZ	R HORZ	IN-SX
R - B	2x4	DRY	No.2	SPF	J UPLIFT	J UPLIFT	IN-SX
J - H	2x4	DRY	No.2	SPF	R	R	
R - O	2x4	DRY	No.2	SPF	J	J	
O - M	2x4	DRY	No.2	SPF			
M - J	2x4	DRY	No.2	SPF			

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
R	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0
J	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.78 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

TMWW-t	MT20	4.0	4.0	2.00	1.75	CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM
--------	------	-----	-----	------	------	--------	-------	---------------------------	---------------------------	-----	---------------	--------------------	-------	---------------------------	---------------	------	-------	---------------------------	---------------	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------	----	-------	------

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN. C.C.
LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015
THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014
(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD
ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.17")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.34")
CSI: TC=0.97/1.00 (E-F:1), BC=0.51/1.00 (K-L:1), WB=0.59/1.00 (H-K:1), SS=0.34/1.00 (E-F:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10
COMPANION LIVE LOAD FACTOR = 1.00
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1856
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.97 (D) (INPUT = 0.90)
JSI METAL= 0.82 (M) (INPUT = 1.00)




Structural component only
DWG# T-2006999

JOB NAME 408089	TRUSS NAME T33	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRAWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	-----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 09:26:44 2020 Page 1
ID:DMCubINVR6TstFoe31v6f_zns11-VCKCz8zcsFc7xeh2kYnL3xTo48JYqADKNMRFUzzNECb

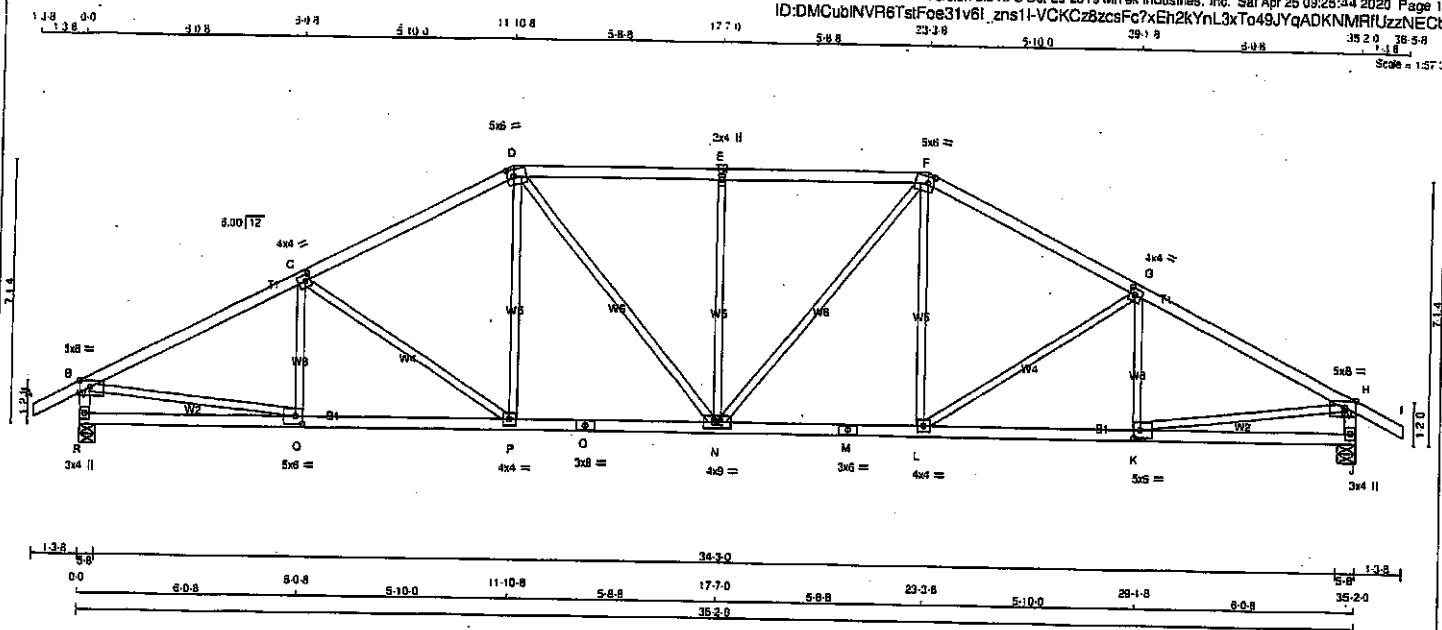

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	NO.2
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TMVW-l	MT20	4.0	4.0	2.00	1.75
D	TMVW-m	MT20	5.0	6.0	2.25	2.00
E	TMVW-w	MT20	2.0	4.0		
F	TMVW-m	MT20	5.0	8.0	2.25	2.00
G	TMVW-l	MT20	4.0	4.0	2.00	1.75
H	TMVW-p	MT20	5.0	8.0	Edge	3.50
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-l	MT20	5.0	6.0	2.50	2.25
L	BMVW-l	MT20	5.0	6.0	2.50	2.25
M	BS-l	MT20	3.0	4.0		
N	BMVW-l	MT20	4.0	4.0		
O	BS-l	MT20	3.0	4.0		
P	BMVW-l	MT20	4.0	4.0		
Q	BMVW-l	MT20	5.0	6.0	2.50	2.25
R	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
R	2083	0	2083	0
J	2083	0	2083	0

UNFACTORED REACTIONS

	1ST LCASE	MAX MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
R	1457	999 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	
J	1457	999 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LCI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LCI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	Q-C	-255 / 12	0.07 (1)
B-C	-2889 / 0	-91.8	-91.8 0.58 (1)	3.58	C-P	-435 / 0	0.42 (1)
C-D	-2539 / 0	-91.8	-91.8 0.52 (1)	3.83	P-D	0 / 350	0.08 (1)
D-E	-2559 / 0	-91.8	-91.8 0.48 (1)	3.85	D-N	0 / 482	0.11 (1)
E-F	-2559 / 0	-91.8	-91.8 0.48 (1)	3.85	N-E	-841 / 0	0.56 (1)
F-G	-2539 / 0	-91.8	-91.8 0.52 (1)	3.83	N-F	0 / 482	0.11 (1)
G-H	-2889 / 0	-91.8	-91.8 0.58 (1)	3.58	L-F	0 / 350	0.08 (1)
H-I	0 / 28	-91.8	-91.8 0.12 (1)	10.00	L-G	-435 / 0	0.42 (1)
R-B	-2014 / 0	0.0	0.0 0.20 (1)	5.95	K-G	-255 / 12	0.07 (1)
J-H	-2014 / 0	0.0	0.0 0.20 (1)	5.95	B-Q	0 / 2635	0.59 (1)
					K-H	0 / 2635	0.59 (1)
R-Q	0 / 0	-18.5	-18.5 0.15 (4)	10.00			
Q-P	0 / 2809	-18.5	-18.5 0.49 (1)	10.00			
P-O	0 / 2249	-18.5	-18.5 0.43 (1)	10.00			
O-N	0 / 2249	-18.5	-18.5 0.43 (1)	10.00			
N-M	0 / 2249	-18.5	-18.5 0.43 (1)	10.00			
M-L	0 / 2249	-18.5	-18.5 0.43 (1)	10.00			
L-K	0 / 2809	-18.5	-18.5 0.49 (1)	10.00			
K-J	0 / 0	-18.5	-18.5 0.15 (4)	10.00			

TOTAL WEIGHT = 2 X 145 = 289 lb

(M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 38.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (1.17')
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.15')
ALLOWABLE DEFL. (TL) = $L/360$ (1.17')
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.28')

CSI: TC=0.58/1.00 (G-H:1), BC=0.49/1.00 (K-L:1),
WB=0.59/1.00 (H-K:1), SS=0.25/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN
MT20	618	354	1667	788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.89 (K) (INPUT = 0.90)
JSI METAL= 0.69 (M) (INPUT = 1.00)

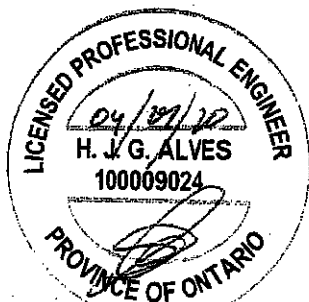

Structural component only
DWG# T-2007000

Structural component only
DWG# T-2007001

JOB NAME 408089	TRUSS NAME T35	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 5 Oct 2019 MTEK Industries, Inc. Sat Apr 25 09:25:47 2020 Page 1	
ID:DMCubINVR6TstFoe31vdl_zns1-vn0Lb9?UBA_ashQdPgK2ha5MBMU61Xgn3Kgu5izNECY				Scale = 1/8" = 1'-0"	

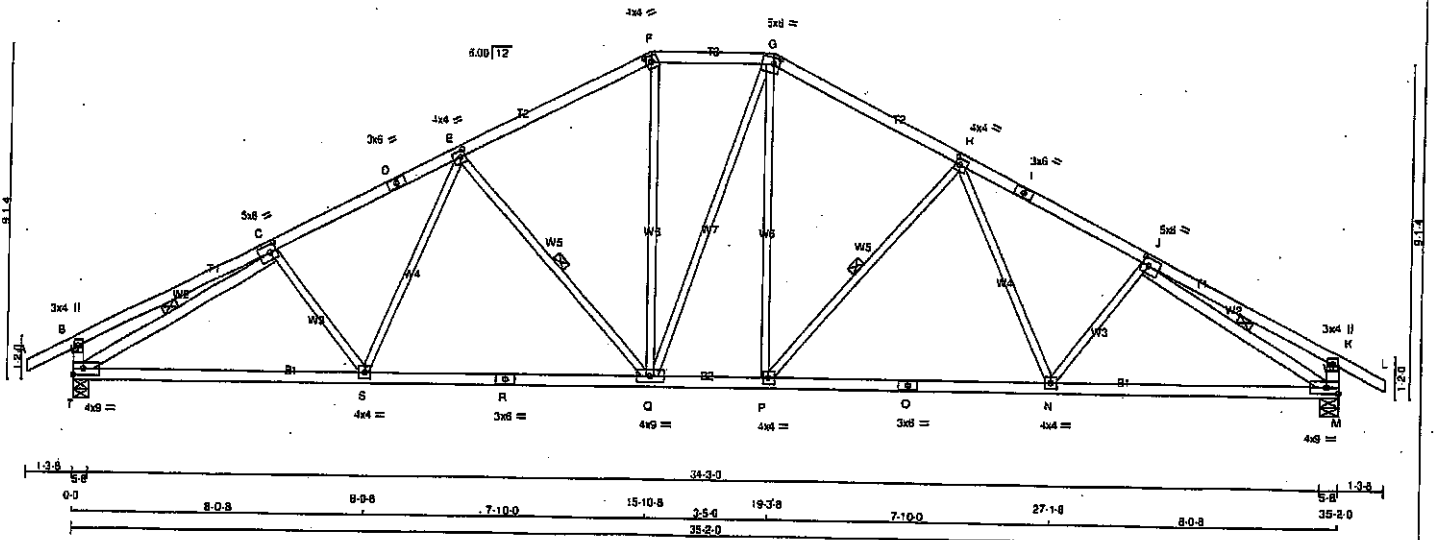

LUMBER			
N.L.G.A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
L - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
T - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
T - C	2x4	DRY	No.2
J - M	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV-p	MT20	3.0	4.0		
C TMWW-i	MT20	5.0	6.0	2.50	2.25
D TS-t	MT20	3.0	6.0		
E TMWW-i	MT20	4.0	4.0	2.00	1.50
F TTW-h	MT20	4.0	4.0	2.00	1.75
G TTWW-m	MT20	5.0	6.0	2.00	2.00
H TMWW-i	MT20	4.0	4.0	2.00	1.50
I TS-t	MT20	3.0	6.0		
J TMWW-i	MT20	5.0	6.0	2.50	2.25
K TMV-p	MT20	3.0	4.0		
M TMWW-i	MT20	4.0	9.0		Edge
N, P, S					
N BMWW-i	MT20	4.0	4.0		
O BS-t	MT20	3.0	5.0		
Q BMWW-i	MT20	4.0	9.0		
R BS-t	MT20	3.0	6.0		
T BMWW-i	MT20	4.0	9.0		Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED DOWN REACTION		INPUT BRG UPLIFT		RECORD BRG IN-SX	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
T	2063	0	2063	0	0	5-8	5-8	5-8	5-8
M	2063	0	2063	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
T	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
M	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, H-P, C-T, J-M

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CS1 (LC)	MAX. UNBRACED LENGTH	FR-TO	MEMB.	FORCE (LBS)	MAX. UNBRACED LENGTH	FR-TO
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	C-S	-110 / 37	0.04 (1)		
B-C	0 / 20	-91.8	-91.8 0.32 (1)	10.00	S-E	0 / 277	0.06 (1)		
C-D	-2760 / 0	-91.8	-91.8 0.40 (1)	3.88	E-Q	-681 / 0	0.31 (1)		
D-E	-2760 / 0	-91.8	-91.8 0.40 (1)	3.88	Q-F	0 / 613	0.14 (1)		
E-F	-2167 / 0	-91.8	-91.8 0.36 (1)	4.30	Q-G	0 / 4	0.00 (1)		
F-G	-1925 / 0	-91.8	-91.8 0.18 (1)	4.71	P-G	0 / 609	0.14 (1)		
G-H	-2165 / 0	-91.8	-91.8 0.36 (1)	4.30	P-H	-683 / 0	0.31 (1)		
H-I	-2761 / 0	-91.8	-91.8 0.40 (1)	3.88	H-N	0 / 279	0.06 (1)		
I-J	-2761 / 0	-91.8	-91.8 0.40 (1)	3.88	N-J	-110 / 37	0.04 (1)		
J-K	0 / 20	-91.8	-91.8 0.32 (1)	10.00	T-C	-3042 / 0	0.61 (1)		
K-L	0 / 28	-91.8	-91.8 0.12 (1)	10.00	J-M	-3043 / 0	0.61 (1)		
T-B	-325 / 0	0.0	0.0 0.03 (1)	7.81					
M-K	-325 / 0	0.0	0.0 0.03 (1)	7.81					
T-S	0 / 2536	-18.5	-18.5 0.56 (1)	10.00					
S-R	0 / 2362	-18.5	-18.5 0.53 (1)	10.00					
R-Q	0 / 2362	-18.5	-18.5 0.53 (1)	10.00					
Q-P	0 / 1924	-18.5	-18.5 0.40 (1)	10.00					
P-O	0 / 2362	-18.5	-18.5 0.53 (1)	10.00					
O-N	0 / 2362	-18.5	-18.5 0.53 (1)	10.00					
N-M	0 / 2536	-18.5	-18.5 0.56 (1)	10.00					

TOTAL WEIGHT = 2 X 155 = 310 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 33.0 PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.29")

CS1: TC=0.40/1.00 (H-J:1), BC=0.56/1.00 (M-N:1), WS=0.61/1.00 (J-M:1), SS1=0.20/1.00 (E-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PLJ)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (F) (INPUT = 0.90)
JSI METAL= 0.83 (O) (INPUT = 1.00)



Structural component only
DWG# T-2007002

JOB NAME 408089	TRUSS NAME T36	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

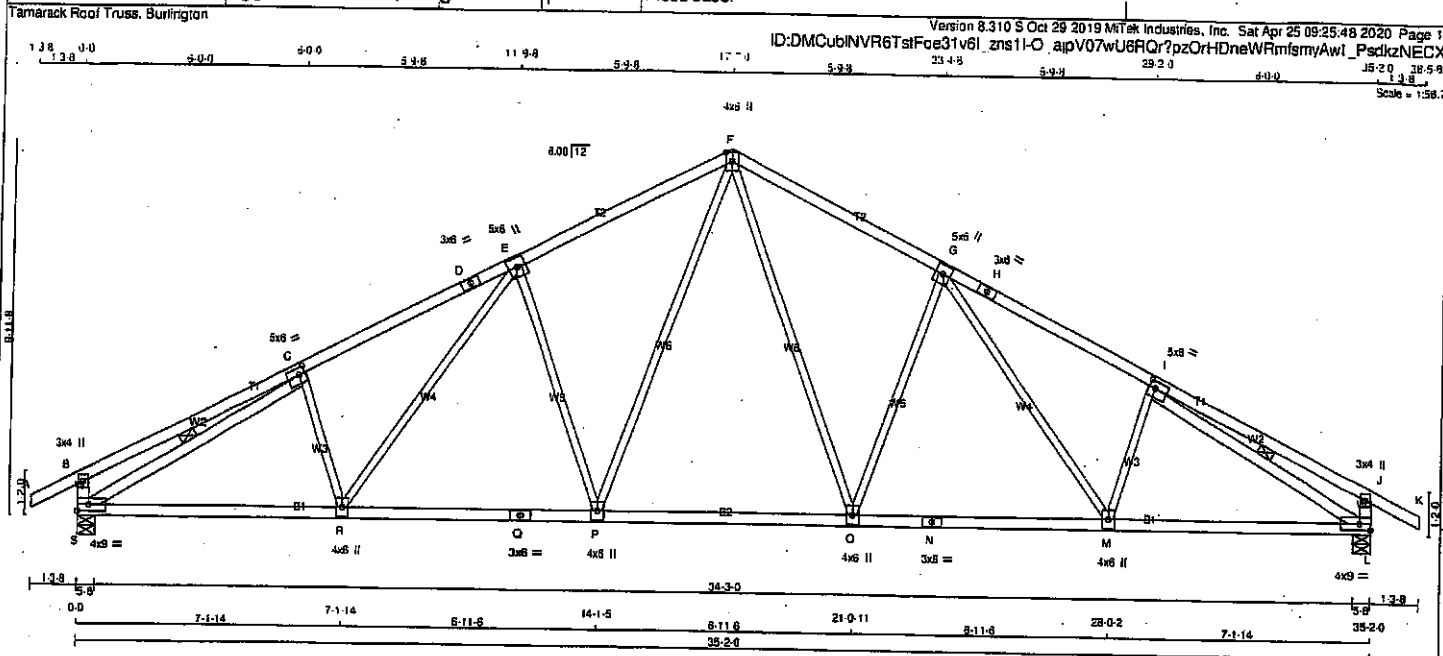

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
O - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV-p	MT20	3.0	4.0
C	TMWW-I	MT20	5.0	6.0 2.25 2.00
D	TS-I	MT20	3.0	6.0
E	TMWW-I	MT20	5.0	6.0
F	TTWW-p	MT20	4.0	6.0 Edge
G	TMWW-I	MT20	5.0	6.0
H	TS-I	MT20	3.0	6.0
I	TMWW-I	MT20	5.0	6.0 2.25 2.00
J	TMV-p	MT20	3.0	4.0
L	BMVW-I	MT20	4.0	9.0 Edge
M, O, P, R				
M	BMWW-I	MT20	4.0	6.0
N	BS-I	MT20	3.0	6.0
Q	BS-I	MT20	3.0	6.0
S	BMVW-I	MT20	4.0	9.0 Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
	FACTORED	MAXIMUM FACTORED	INPUT
	GROSS REACTION	GROSS REACTION	REQD
	VERT	DOWN	BRG
	HORZ	HORZ	IN-SX
JT	2083	0	5-8
S	2083	0	5-8
L	2083	0	5-8

UNFACTORED REACTIONS						
1ST LCASE	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
JT	1457	989 / 0	0 / 0	0 / 0	488 / 0	0 / 0
S	1457	989 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1457	989 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, I-L

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
FR-TO			
A-B	0 / 28	-91.8	10.00
B-C	0 / 22	-91.8	10.00
C-D	-2808 / 0	-91.8	10.00
D-E	-2808 / 0	-91.8	10.00
E-F	-2322 / 0	-91.8	10.00
F-G	-2322 / 0	-91.8	10.00
G-H	-2808 / 0	-91.8	10.00
H-I	-2808 / 0	-91.8	10.00
I-J	0 / 22	-91.8	10.00
J-K	0 / 28	-91.8	10.00
K-L	-344 / 0	0.0	10.00
L-M	-344 / 0	0.0	10.00
S-R	0 / 2574	-18.5	10.00
R-Q	0 / 2291	-18.5	10.00
Q-P	0 / 2291	-18.5	10.00
P-O	0 / 1762	-18.5	10.00
O-N	0 / 2291	-18.5	10.00
N-M	0 / 2291	-18.5	10.00
M-L	0 / 2574	-18.5	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSI: TC=0.49/1.00 (G-I), BC=0.53/1.00 (L-M), WB=0.72/1.00 (G-O), SSI=0.22/1.00 (N-J)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (FLU) (FLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 768 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (I) (INPUT = 0.90)
JSI METAL = 0.77 (I) (INPUT = 1.00)

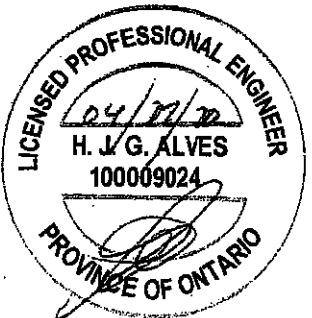

Structural component only
DWG# T-2007003

JOB NAME 408089	TRUSS NAME T37	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:25:49 2020 Page 1	
ID:DMCubINVR6TstFoe31v6f_zns1f-sA850r1hoE12?a7X5NWm?Ad5A0pVUH3Xa9QAAzNECW				Scale = 1:48.5	

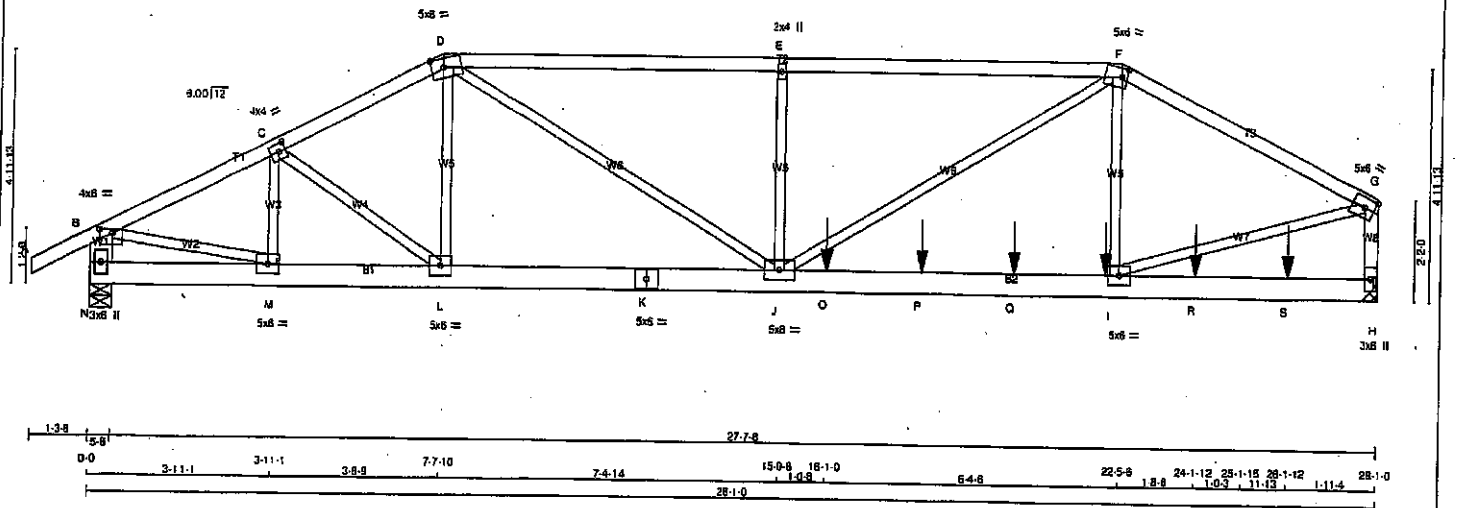

LUMBER	N.L.G.A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - F	2x4	DRY	No.2	SPF		
F - G	2x4	DRY	No.2	SPF		
N - B	2x8	DRY	No.2	SPF		
H - G	2x4	DRY	No.2	SPF		
N - K	2x6	DRY	No.2	SPF		
K - H	2x6	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS	#ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS			
A-D	1	12	TOP
D-F	1	12	TOP
F-G	1	12	TOP
H-G	1	12	TOP
N-B	2	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS			
N-K	2	12	TOP
K-H	2	12	TOP
WEBS: (0.122"x3") SPIRAL NAILS			
2x3	1	8	TOP

NAILED TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PILES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	UPLIFT	IN-SX
N	2368	0	0	5-8
H	2951	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 4'-0".

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
N	1689	1129 / 0	0 / 0	0 / 0	0 / 0	540 / 0	0 / 0
H	2078	1414 / 0	0 / 0	0 / 0	0 / 0	684 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.70 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. CS1 (LC)	MAX. UNBRAC LENGTH	WEBS	MAX. FACTORED MEMB. FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 28	-91.8	-91.8	0.07 (1)	10.00	M-C	-537 / 0
B-C	-3250 / 0	-91.8	-91.8	0.14 (1)	5.04	C-L	0 / 112
C-D	-3386 / 0	-91.8	-91.8	0.15 (1)	4.95	L-D	-35 / 73
D-E	-4857 / 0	-91.8	-91.8	0.75 (1)	3.70	D-J	0 / 2173
E-F	-4857 / 0	-91.8	-91.8	0.75 (1)	3.70	J-E	-827 / 0
F-G	-3557 / 0	-91.8	-91.8	0.38 (1)	4.81	J-F	0 / 1975
N-B	-2368 / 0	0.0	0.0	0.08 (1)	7.81	I-F	0 / 79
H-G	-2836 / 0	0.0	0.0	0.17 (1)	8.81	I-G	0 / 3328
					B-M	0 / 2977	0.37 (1)
N-M	0 / 0	-18.5	-18.5	0.04 (1)	10.00		
M-L	0 / 2921	-18.5	-18.5	0.23 (1)	10.00		
L-K	0 / 3011	-18.5	-18.5	0.39 (1)	10.00		
K-J	0 / 3011	-18.5	-18.5	0.39 (1)	10.00		
J-O	0 / 3180	-18.5	-18.5	0.48 (1)	10.00		
O-P	0 / 3180	-18.5	-18.5	0.48 (1)	10.00		
P-Q	0 / 3180	-18.5	-18.5	0.48 (1)	10.00		
Q-I	0 / 3180	-18.5	-18.5	0.48 (1)	10.00		
I-R	0 / 0	-18.5	-18.5	0.24 (1)	10.00		
R-S	0 / 0	-18.5	-18.5	0.24 (1)	10.00		
S-H	0 / 0	-18.5	-18.5	0.24 (1)	10.00		

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL
I	22-1-12	-187	-187	---	FRONT	VERT	---
O	18-1-0	-1187	-1187	---	FRONT	VERT	---
P	18-1-12	-187	-187	---	FRONT	VERT	---
Q	20-1-12	-187	-187	---	FRONT	VERT	---
R	24-1-12	-198	-198	---	FRONT	VERT	---
S	26-1-12	-173	-173	---	FRONT	VERT	---

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT. CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.94")
CALCULATED VERT. DEFL.(LL) = L/999 (0.13")
ALLOWABLE DEFL.(TL) = L/360 (0.94")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CS1: TC=0.75/1.00 (D-E-1), BC=0.48/1.00 (I-J-1), WB=0.41/1.00 (G-I-1), SS=0.40/1.00 (K-J-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00, COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (F) (INPUT = 0.90)
JSI METAL = 0.45 (G) (INPUT = 1.00)

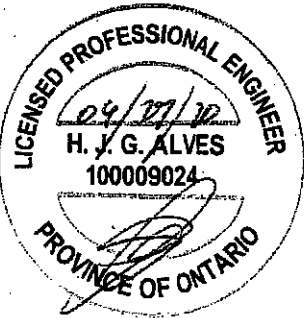

Structural component only
DWG# T-2007004 1/2

JOB NAME 408089	TRUSS NAME T37	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Sat Apr 25 09:25:49 2020 Page 2
ID:DMCubiNVR6TstFoe31v6l zns1l-sA850rt1hoE12?g?X5NNWm?Ad5A0pVUH3Xe9QAAzNECW

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	6.0	1.00	3.25
C	TMVW-t	MT20	4.0	4.0	2.00	1.75
D	TTVW-m	MT20	5.0	6.0	2.25	3.25
E	TMVW-w	MT20	2.0	4.0		
F	TTVW-m	MT20	5.0	6.0	2.25	1.50
G	TMVW-t	MT20	5.0	6.0		Edge
H	BMV1-p	MT20	3.0	6.0		
I, L, M						
I	BMVW-t	MT20	5.0	6.0		
J	BMVWVW-t	MT20	5.0	6.0		
K	BS-t	MT20	5.0	6.0		
N	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

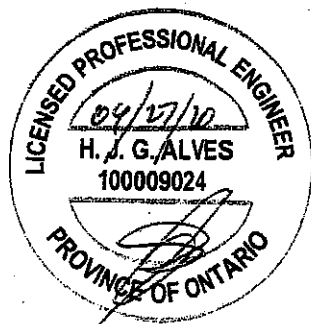


Structural component only
DWG# T-2007004 7/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408089	T38	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 09:25:30 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns1H-KMITEB2N8SM99985puJCjukaOpEwuDiluzidzNECV

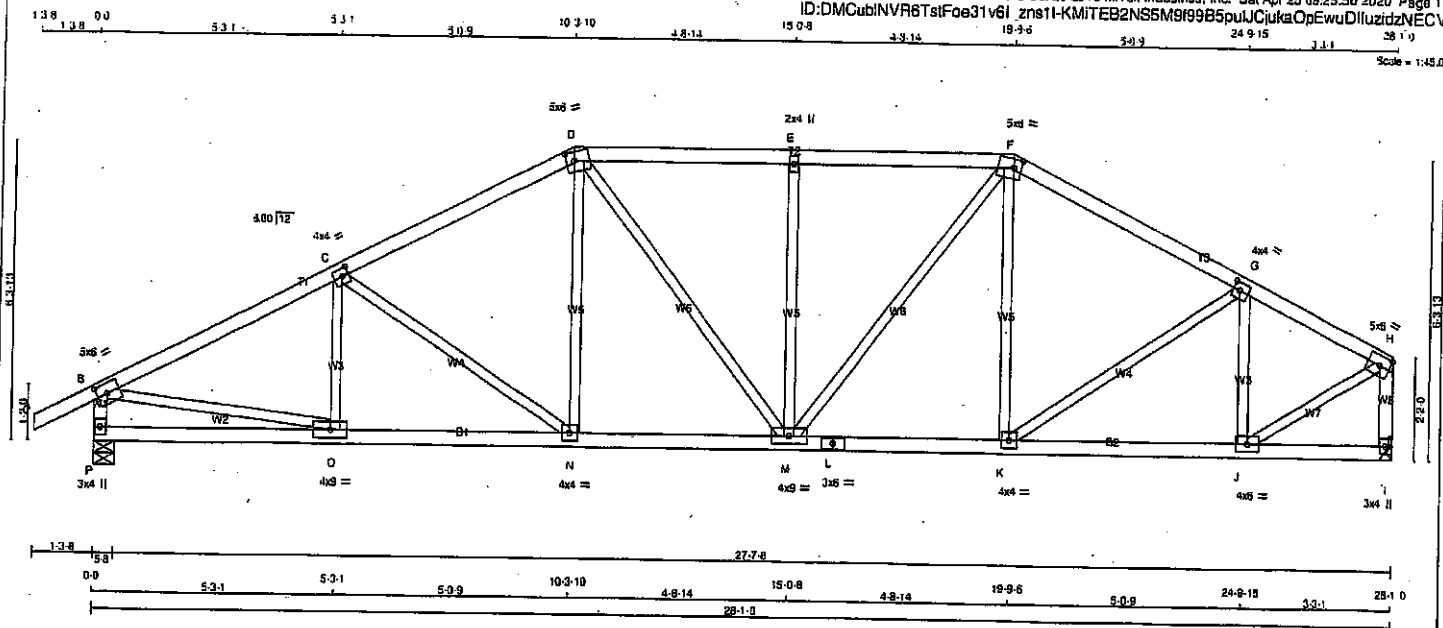

LUMBER			
N. L. G. A. RULES	SIZE	DRY	NO.2
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
L - I	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMWW-I	MT20	5.0	6.0 2.50 2.75
C	TMWW-I	MT20	4.0	4.0 2.00 1.75
D	TTWW-m	MT20	5.0	6.0 2.25 2.00
E	TMWW-m	MT20	2.0	4.0
F	TTWW-m	MT20	5.0	6.0 2.25 2.00
G	TMWW-I	MT20	4.0	4.0 2.00 1.75
H	TMWW-I	MT20	5.0	6.0 Edge
I	BMV-I-p	MT20	3.0	4.0
J	BMWW-I	MT20	4.0	5.0
K	BMWW-I	MT20	4.0	4.0
L	BS-I	MT20	3.0	6.0
M	BMWWWW-I	MT20	4.0	9.0
N	BMWW-I	MT20	4.0	9.0
O	BMWW-I	MT20	4.0	9.0
P	BMV-I-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
P	1873	0	1873	0	0	5-8	5-8
I	1548	0	1548	0	0	MECHANICAL	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS							
1ST LCASE	MAX	MIN	COMPONENT	REACTIONS			
JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
P	1181	786 / 0	0 / 0	0 / 0	0 / 0	393 / 0	0 / 0
I	1095	718 / 0	0 / 0	0 / 0	0 / 0	376 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING							
TOTAL LOAD CASES: (4)							
CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	

FR-TO	FROM	TO	LENGTH	FR-TO	FROM	TO	LENGTH
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	O-C	-224 / 10	0.05 (1)
B-C	-2197 / 0	-91.8	-91.8 0.38 (1)	4.25	C-N	-370 / 0	0.25 (1)
C-D	-1905 / 0	-91.8	-91.8 0.35 (1)	4.53	N-D	0 / 303	0.07 (1)
D-E	-1838 / 0	-91.8	-91.8 0.30 (1)	4.66	D-M	0 / 247	0.08 (1)
E-F	-1838 / 0	-91.8	-91.8 0.30 (1)	4.66	M-E	-530 / 0	0.34 (1)
F-G	-1741 / 0	-91.8	-91.8 0.31 (1)	4.79	M-F	0 / 527	0.12 (1)
G-H	-1474 / 0	-91.8	-91.8 0.25 (1)	5.14	K-F	-15 / 63	0.02 (4)
P-B	-1629 / 0	0.0	0.0 0.16 (1)	6.48	K-G	0 / 202	0.05 (1)
I-H	-1524 / 0	0.0	0.0 0.18 (1)	6.85	J-G	-687 / 0	0.16 (1)
P-O	0 / 0	-18.5	-18.5 0.11 (4)	10.00	B-O	0 / 2012	0.45 (1)
O-N	0 / 1988	-18.5	-18.5 0.37 (1)	10.00	J-H	0 / 1548	0.35 (1)
N-M	0 / 1885	-18.5	-18.5 0.32 (1)	10.00			
M-L	0 / 1512	-18.5	-18.5 0.30 (1)	10.00			
L-K	0 / 1512	-18.5	-18.5 0.30 (1)	10.00			
K-J	0 / 1345	-18.5	-18.5 0.27 (1)	10.00			
J-I	0 / 0	-18.5	-18.5 0.07 (4)	10.00			

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.8 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.94")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL)= L/360 (0.94")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.38/1.00 (B-C:1), BC=0.37/1.00 (N-O:1), WB=0.45/1.00 (B-O:1), SS=0.21/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP(DRY)	SHEAR	SECTION	
(PSI)	(PL)	(PL)	
MAX MIN	MAX MIN	MAX MIN	
MT20	818	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (J) (INPUT = 0.90)
JSI METAL = 0.59 (B) (INPUT = 1.00)

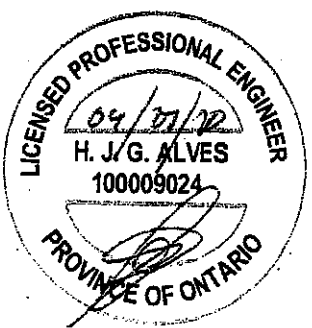


Structural component only
DWG# T-2007005

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408089	T40	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:25:52 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1-GlpEa3d_ictvStaCEwDOdoGQn3fpzWDcN4mVzNECT

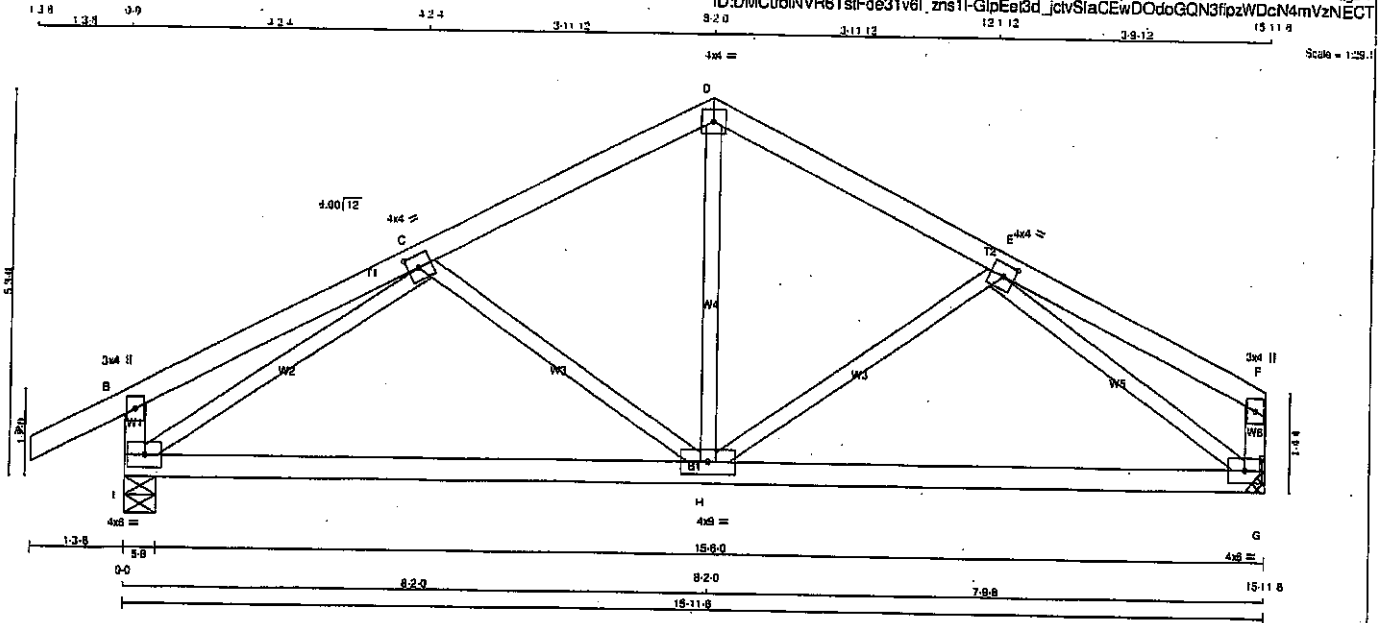

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
I - B	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SRF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWV-I	MT20	4.0	4.0	2.00	1.75
D	TTW-p	MT20	4.0	4.0		
E	TMWV-I	MT20	4.0	4.0	2.00	1.75
F	TMV+p	MT20	3.0	4.0		
G	BMVW1-I	MT20	4.0	6.0		
H	BMVW1-I	MT20	4.0	6.0		
I	BMVW1-I	MT20	4.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
	VERT	DOWN	SRG	SRG
I	1004	0	0	IN-SX
G	880	0	0	5-8 MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERMALIVE	WIND	DEAD	SOIL
I	708	478/0	0/0	0/0	0/0	230/0	0/0
G	622	408/0	0/0	0/0	0/0	214/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO		FROM TO		FR-TO		
A-B	0/28	-91.8 -91.8 0.12 (1)	10.00	C-H	-263/0	0.11 (1)
B-C	0/19	-91.8 -91.8 0.24 (1)	10.00	H-D	0/445	0.10 (1)
C-D	-844/0	-91.8 -91.8 0.19 (1)	6.25	H-E	-190/0	0.08 (1)
D-E	-842/0	-91.8 -91.8 0.17 (1)	6.25	I-C	-1167/0	0.48 (1)
E-F	0/19	-91.8 -91.8 0.22 (1)	10.00	E-G	-1132/0	0.41 (1)
F-B	-270/0	0.0 0.0 0.03 (1)	7.81			
G-F	-129/0	0.0 0.0 0.01 (1)	7.81			
I-H	0/952	-18.5 -18.5 0.41 (4)	10.00			
H-G	0/892	-18.5 -18.5 0.41 (4)	10.00			

TOTAL WEIGHT = 61 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/960$ (0.53")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.02")
ALLOWABLE DEFL.(TL) = $L/960$ (0.53")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.12")

CSI: TC=0.24/1.00 (B-C:1), BC=0.41/1.00 (H-I:4),
WB=0.48/1.00 (C-I:1), SSI=0.16/1.00 (B-C:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	618	354	1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.83 (E) (INPUT = 0.90)
JSI METAL = 0.39 (C) (INPUT = 1.00)

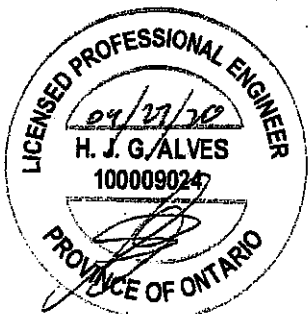


Structural component only
DWG# T-2007007

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408089	T41	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITak Industries, Inc. Sat Apr 25 08:25:54 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-C8x_3Y5IVKsa8mSzKlyhT2uSsBn7AmnpgwsBrOzNECR

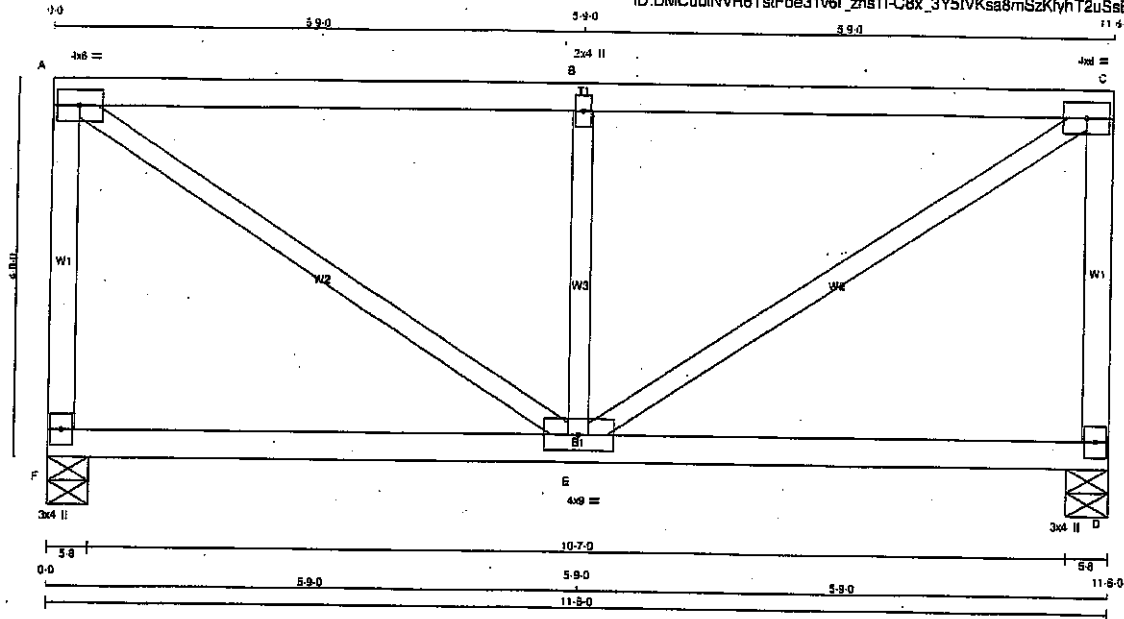

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408089	G41	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:25:34 2020 Page 1	

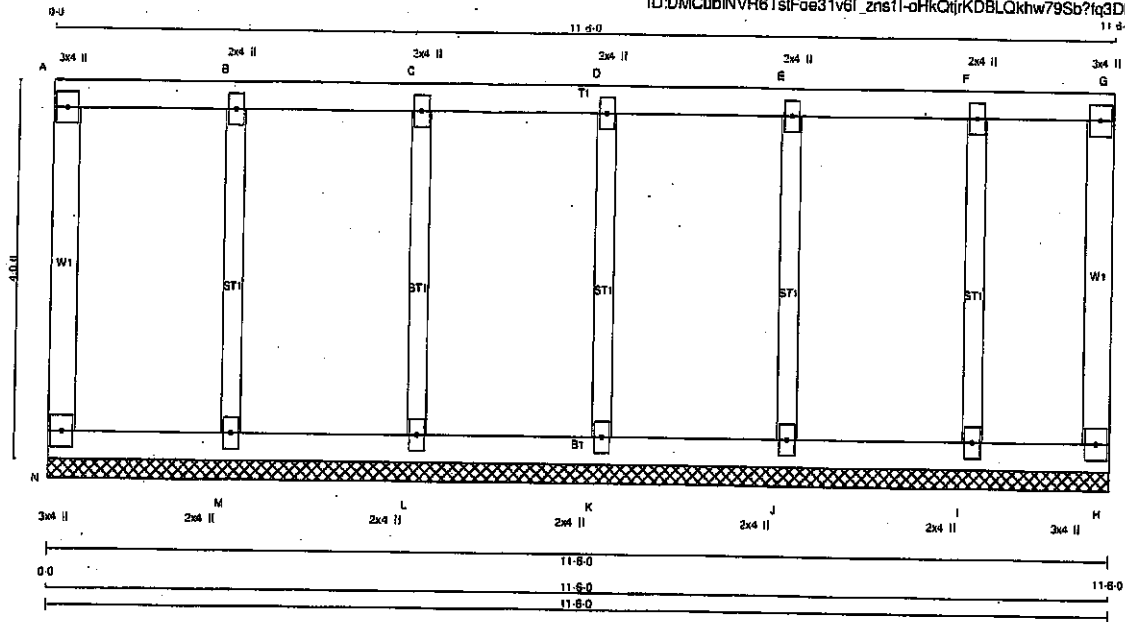

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
N - A	2x4	DRY	No.2	SPF
A - G	2x4	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF
N - H	2x4	DRY	No.2	SPF

ALL WEBS	2x3	DRY	No.2	SPF
ALL GABLE WEBS	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B, C, D, E, F						
G	TMV+w	MT20	2.0	4.0		
H	BMV1+p	MT20	3.0	4.0		
I, J, K, L, M						
N	BMV1+w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 (LC)
FR-TO		FROM TO			FR-TO		
N-A	-100 / 0	0.0 0.0 0.03 (1)	7.81	M-B	-244 / 0	0.08 (1)	
A-B	-5 / 0	-114.3 -114.3 0.08 (1)	10.00	L-C	-226 / 0	0.07 (1)	
B-C	-5 / 0	-114.3 -114.3 0.08 (1)	10.00	K-D	-228 / 0	0.07 (1)	
C-D	-5 / 0	-114.3 -114.3 0.07 (1)	10.00	J-E	-234 / 0	0.08 (1)	
D-E	-5 / 0	-114.3 -114.3 0.07 (1)	10.00	I-F	-207 / 0	0.07 (1)	
E-F	-5 / 0	-114.3 -114.3 0.07 (1)	10.00				
F-G	-5 / 0	-114.3 -114.3 0.05 (1)	10.00				
G-H	-74 / 0	0.0 0.0 0.02 (1)	7.81				
N-M	0 / 5	-18.5 -18.5 0.02 (4)	10.00				
M-L	0 / 5	-18.5 -18.5 0.02 (4)	10.00				
L-K	0 / 5	-18.5 -18.5 0.02 (4)	10.00				
K-J	0 / 5	-18.5 -18.5 0.02 (4)	10.00				
J-I	0 / 5	-18.5 -18.5 0.02 (4)	10.00				
I-H	0 / 5	-18.5 -18.5 0.02 (4)	10.00				

TOTAL WEIGHT = 48 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.8 PSF
BOT CH.	DL	= 15.0 PSF
	LL	= 0.0 PSF
	OL	= 7.4 PSF
TOTAL LOAD		= 48.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.08/1.00 (B-C:1), BC=0.02/1.00 (M-N:4), WB=0.08/1.00 (B-M:1), SSI=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(FS)	(PL)	(PL)
	MAX	MIN	MAX MIN
MT20	618	354	1867 798 1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.17 (M) (INPUT = 0.90)
JSI METAL= 0.07 (M) (INPUT = 1.00)



Structural component only
DWG# T-2006992

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408089	T43S	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:25:55 2020 Page 1					
ID:DMCubINVR6TsiFoe31v6I_zns1I-gKVMHu6WGe_Rmw19MTw0GQoAbAAvHfyackNqzNECC					
Scale = 1/20					

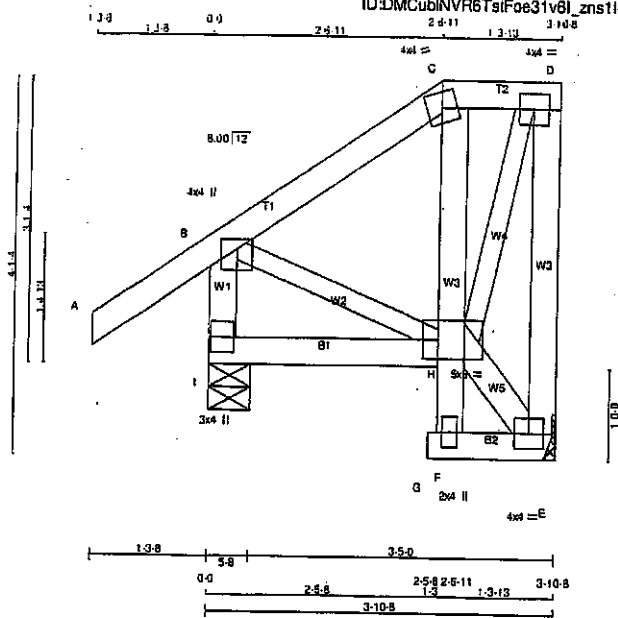

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES	A - C	2x4	DRY	No.2	SPF
	C - D	2x4	DRY	No.2	SPF
	E - D	2x4	DRY	No.2	SPF
	I - B	2x4	DRY	No.2	SPF
	I - H	2x4	DRY	No.2	SPF
	G - E	2x4	DRY	No.2	SPF
	ALL WEBS	2x4	DRY	No.2	SPF
	EXCEPT				
	H - D	2x3	DRY	No.2	SPF
	B - H	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
	B	TMVW+p	MT20	4.0	4.0	1.25 2.00
	C	TTW-m	MT20	4.0	4.0	
	D	TMVW+1	MT20	4.0	4.0	
	E	BMVW+1	MT20	4.0	4.0	
	F	BMVW+w	MT20	2.0	4.0	
	H	BWMWWW+1	MT20	5.0	8.0	2.50 2.00
	I	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
E	216	0	216	0
I	341	0	341	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS							
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	153	99 / 0	0 / 0	0 / 0	0 / 0	54 / 0	0 / 0
I	239	169 / 0	0 / 0	0 / 0	0 / 0	69 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

MAX. UNBRACED INTERIOR CHORD LENGTH = 7.81 FT

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0/35	-81.8	H-E	-10/0
B-C	-81/0	-81.8	H-D	0/152
C-D	-81/0	-81.8	F-H	0/17
E-D	-199/0	0.0	H-C	-133/0
I-B	-318/0	0.0	E-H	0/73
I-H	0/0	-18.5		
G-F	0/0	-18.5		
F-E	0/7	-18.5		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TRIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19')
CALCULATED VERT. DEFL.(LL) = L/999 (0.00')
ALLOWABLE DEFL.(TL) = L/360 (0.19')
CALCULATED VERT. DEFL.(TL) = L/999 (0.00')

CSI: TC=0.14/1.00 (A-B-S), BC=0.04/1.00 (H-I-4),
WB=0.03/1.00 (D-H-1), SS=0.09/1.00 (A-B-S)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	818	354	1687

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP=0.22 (B) (INPUT = 0.90)
JSI METAL=0.06 (B) (INPUT = 1.00)

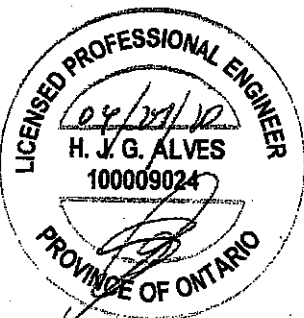

Structural component only
DWG# T-2007009

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408089	T44S	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:25:56 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-9W3kUE681x6IN4cLR379YTzzw_WNekv58EMivGzNECP

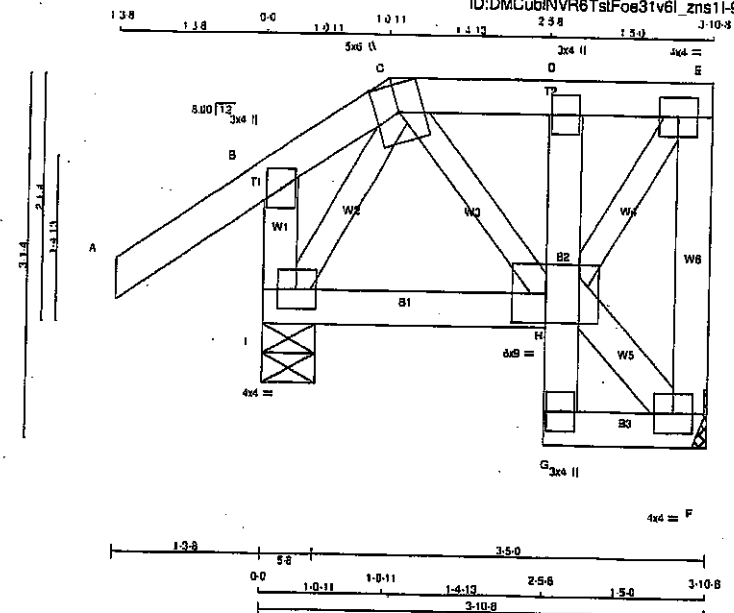

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2
H - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
H - F	2x4	DRY	No.2

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
C	TTWW+tm	MT20	5.0	6.0
D	TMV+p	MT20	3.0	4.0
E	TMVW+1	MT20	4.0	4.0
F	BMVW+1	MT20	4.0	4.0
G	BMV+p	MT20	3.0	4.0
H	BMVW+1	MT20	8.0	9.0
I	BMVW+1	MT20	4.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	BRG	IN-SX	BRG	IN-SX
F	191	0	191	0	0	5-8	MECHANICAL	5-8	
I	362	0	362	0	0				

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	138	87/-12	0/0	0/0	0/0	49/0	0/0
I	253	182/0	0/0	0/0	0/0	71/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0/35	C-H	0/86
B-C	-44/0	H-F	-8/0
C-D	-93/0	H-E	0/155
D-E	-89/0	I-C	-97/38
E-F	-174/0		
F-B	-255/0		
I-H	-20/50		
G-H	0/13		
H-D	-147/0		
G-F	0/7		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 24 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (A-B-5), BC=0.04/1.00 (H-I-4), WB=0.03/1.00 (E-H-1), SI=0.09/1.00 (A-B-5)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MT20	618	354	1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.27 (H) INPUT = 0.90 ;

JSI METAL= 0.09 (B) INPUT = 1.00 ;

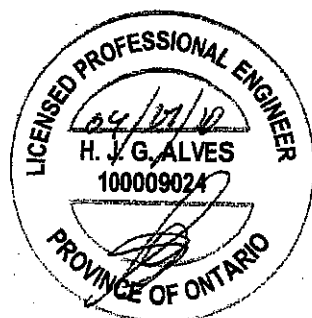


Structural component only
DWG# T-2007010

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408089	T45	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 09:25:57 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns11-djd7ia7moFE9?nWoshWshOnnN5ZFMu5rSizNECO

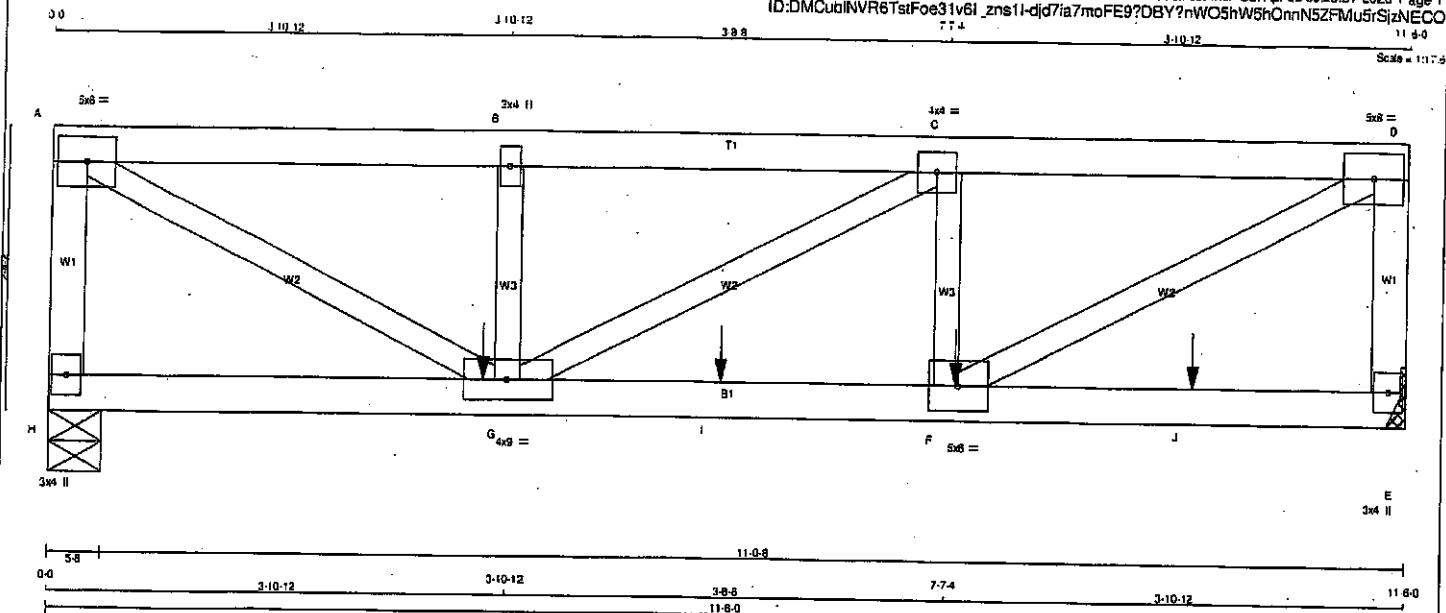

LUMBER	DESCR.
N. L. G. A. RULES	
CHORDS	
H - A 2x4 DRY No.2	SPF
A - D 2x4 DRY No.2	SPF
E - D 2x4 DRY No.2	SPF
H - E 2x4 DRY No.2	SPF
ALL WEBS 2x3 DRY No.2	SPF
DRY: SEASONED LUMBER.	

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
H - A 1 12	TOP	
A - D 1 12	SIDE(30.4)	
D - E 1 12	TOP	
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
H - E 1 12	SIDE(20.3)	
WEBS : (0.122"x3") SPIRAL NAILS		
F - C 1 6	SIDE(6.6)	
G - B 1 6	SIDE(6.6)	
2x3 1 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMW-1	MT20	5.0	6.0		
B	TMW-w	MT20	2.0	4.0		
C	TMW-1	MT20	4.0	4.0		
D	TMW-1	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
H	1429	0	1429	0
E	1498	0	1498	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 2'-0".

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	1038	523/0	0/0	0/0	0/0	515/0	0/0
E	1086	561/0	0/0	0/0	0/0	525/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.18 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			FACTORED			WEBS		
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO				FR-TO		
H-A	-1355/0	0.0	0.0	0.12 (1)	7.81	F-D	0 / 2354	0.39 (1)
A-B	-2030/0	-175.1	-175.1	0.27 (1)	5.24	A-G	0 / 2295	0.38 (1)
B-C	-2030/0	-175.1	-175.1	0.25 (1)	5.28	F-C	-694/0	0.08 (1)
C-D	-2083/0	-175.1	-175.1	0.27 (1)	5.18	G-B	-721/0	0.08 (1)
E-D	-1383/0	0.0	0.0	0.12 (1)	7.81	G-C	-60/0	0.01 (1)
H-G	0/0	-43.5	-43.5	0.10 (4)	10.00			
G-I	0 / 2083	-43.5	-43.5	0.35 (1)	10.00			
I-F	0 / 2083	-43.5	-43.5	0.35 (1)	10.00			
F-J	0/0	-43.5	-43.5	0.14 (1)	10.00			
J-E	0/0	-43.5	-43.5	0.14 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOG	LC1	MAX	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	7-8-4	-103	-103		FRONT	VERT	TOTAL		C1
G	3-8-4	-103	-103		FRONT	VERT	TOTAL		C1
I	5-8-4	-103	-103		FRONT	VERT	TOTAL		C1
J	9-8-4	-103	-103		FRONT	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 43 = 86 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:	
TOP CH. LL = 25.6 PSF	
DL = 15.0 PSF	
BOT CH. LL = 0.0 PSF	
DL = 7.4 PSF	
TOTAL LOAD = 48.0 PSF	

SPACING = 24.0 IN./C/C

LOADING IN PLAT SECTION BASED ON A SLOPE OF 0.00/12

GIRDER TYPE: CStdGirder
START DISTANCE = 0-0
START SPAN CARRIED = 4-0-0
END DISTANCE = 11-6-0
END SPAN CARRIED = 4-0-0
END WALL WIDTH = 2-0
APPLIED TO FRONT SIDE OF TOP CHORD.
- ADDTL LOADS BASED ON 55 % OF GSL

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 085-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.38")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.38")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CS1: TC=0.27/1.00 (C-D:1), BC=0.35/1.00 (F-G:1),
WB=0.39/1.00 (D-F:1), SS1=0.23/1.00 (C-D:1)


DOL LUMBER=0.99 NAIL=0.99 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES	PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667	789 1987 1656

CONTINUED ON PAGE 2

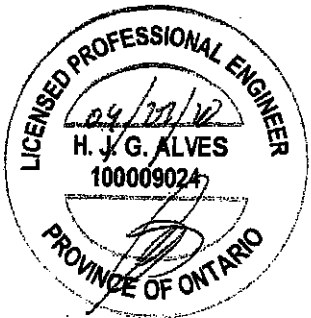

Structural component only
DWG# T-2007011

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408089	T45	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:25:57 2020 Page 2

ID:DMCubINVR6TstFoe31v6I zns1I-dId7ia7moFE9?DBY?nWQshWShOnnN5ZFmu5rSizNECO


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
E	BMVt+p	MT20	3.0	4.0		
F	BMWW-1	MT20	5.0	6.0		
G	BMWW-1	MT20	4.0	9.0		
H	BMVt+p	MT20	3.0	4.0		

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.81 (G) (INPUT = 0.90)
JSI METAL = 0.35 (D) (INPUT = 1.00)

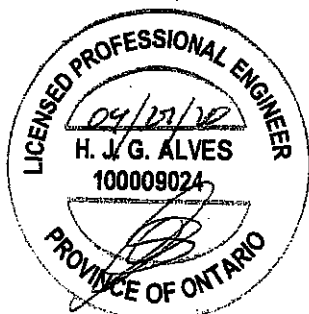

Structural component only
DWG# T-2007011

DRWG NO



TOTAL WEIGHT = 61 lb

DESIGN CRITERIA

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A
SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2018
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI=TC=0.30/1.00 (C-D:1), BC=0.09/1.00 (A-N:1),
WB=0.14/1.00 (D-K:1), SSI=0.15/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10


COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PLI)		(PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	618	354	1667	788	1987 1658


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

USI GRIP= 0.86 (C) (INPUT = 0.90)
USI METAL= 0.20 (F) (INPUT = 1.00)

JOB NAME 408088	TRUSS NAME V21	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITak Industries, Inc. Sat Apr 25 09:03:41 2020 Page 1
ID: mmH0wk5eA_2Hc98Diso9jzzmVbG-khu3RlykRmwjv2mkCY5xyAlvrsJLwSb91T8Z9zNEXG

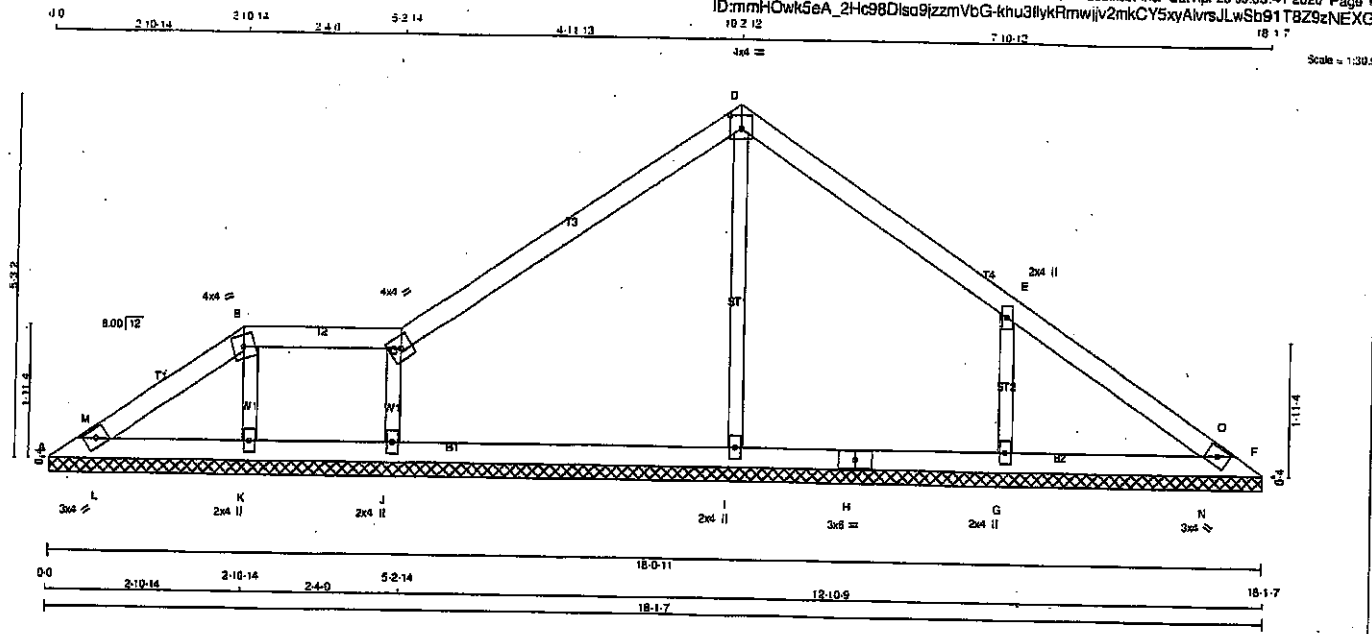

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF
B - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
A - H	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A TBM1-h	MT20	3.0	4.0		
B TTW-m	MT20	4.0	4.0		
C TTW-h	MT20	4.0	4.0		
D TTW-p	MT20	4.0	4.0	2.25	2.00
E TMM-w	MT20	2.0	4.0		
F TBM1-h	MT20	3.0	4.0		
G, I, J, K					
G BMW1-w	MT20	2.0	4.0		
H BS-t	MT20	3.0	8.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
A	136	0	136	0	18-0-11 (11-1184-11)	
F	154	0	154	0	18-0-11 (11-1184-11)	
I	482	0	482	0	18-0-11 (11-1184-11)	
G	519	0	519	0	18-0-11 (11-1184-11)	
K	310	0	310	0	18-0-11 (11-1184-11)	
J	389	0	389	0	18-0-11 (11-1184-11)	

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS				
		SNOW	LIVE	PERM.LIVE	WIND	DEAD
A	96	66/0	0/0	0/0	0/0	30/0
F	109	74/0	0/0	0/0	0/0	34/0
I	343	210/0	0/0	0/0	0/0	133/0
G	366	247/0	0/0	0/0	0/0	119/0
K	218	149/0	0/0	0/0	0/0	70/0
J	276	178/0	0/0	0/0	0/0	97/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, F, I, G, K, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO				
A-M	0/18	-91.8	0/18	-91.8
M-B	0/33	-91.8	0/33	-91.8
B-C	0/38	-91.8	0/38	-91.8
C-D	0/21	-91.8	0/21	-91.8
D-E	-2/14	-91.8	-2/14	-91.8
E-O	0/39	-91.8	0/39	-91.8
O-F	-15/5	-91.8	-15/5	-91.8
A-L	-39/0	-18.5	-39/0	-18.5
L-K	-24/0	-18.5	-24/0	-18.5
K-J	-38/0	-18.5	-38/0	-18.5
J-I	-17/0	-18.5	-17/0	-18.5
I-H	-17/0	-18.5	-17/0	-18.5
H-G	-17/0	-18.5	-17/0	-18.5
G-N	-12/0	-18.5	-12/0	-18.5
N-F	-16/0	-18.5	-16/0	-18.5

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	DL	PSF
LL	25.6	6.0	PSF
DL	0.0	7.4	PSF
TOTAL LOAD	38.0		PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.39/1.00 (C-D:1), BC=0.09/1.00 (K-L:1), WB=0.16/1.00 (D-I:1), SSI=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1687	788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.66 (C) (INPUT = 0.90)
JSI METAL = 0.21 (E) (INPUT = 1.00)




Structural component only
DWG# T-2006985

JOB NAME 408088	TRUSS NAME V22	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:03:43 2020 Page 1
ID:mmHCwk5eA_2Hc9BDiso9jzzmVbG-CISRW5zMB42aL3dziv3KU9jzaFCS4OyNhc5azNEXF

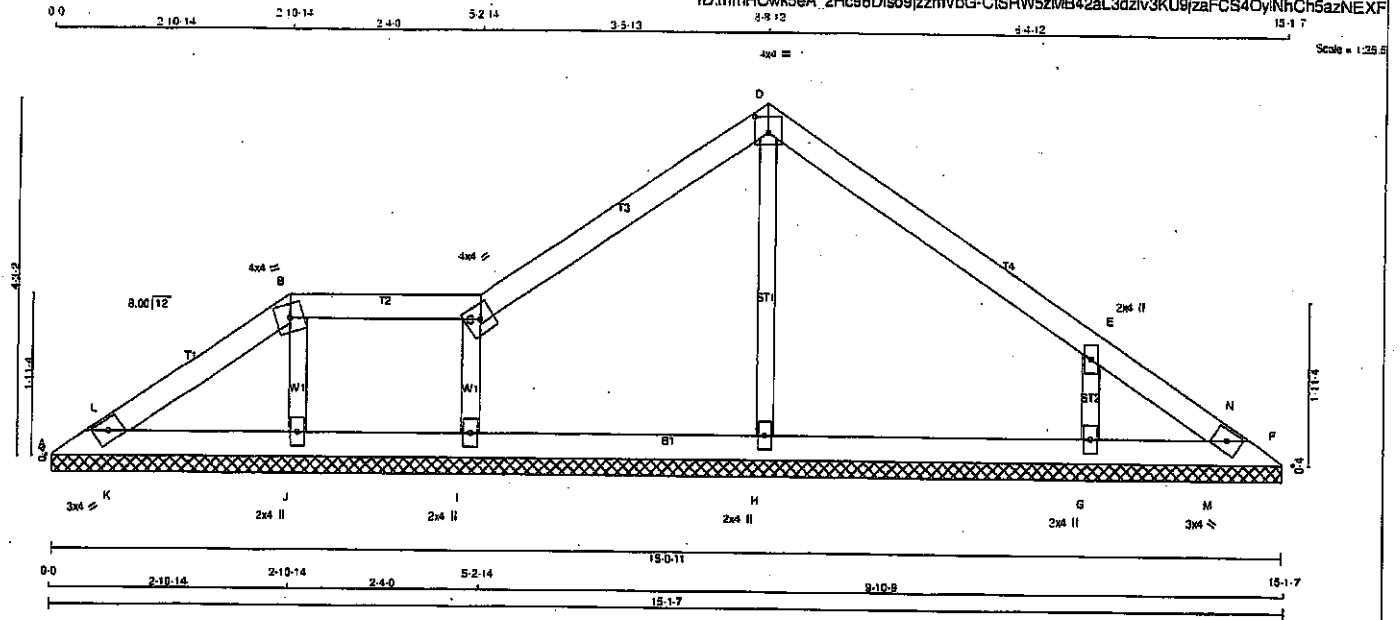

TOTAL WEIGHT = .42 D

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
A - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B	TTW-m	MT20	4.0	4.0		
C	TTW-h	MT20	4.0	4.0		
D	TTW-p	MT20	4.0	4.0	2.25	2.00
E	TMW-w	MT20	2.0	4.0		
F	TBM1-h	MT20	3.0	4.0		
G, H, I, J						
G	BMW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	RECORD BRG IN-SX
JT	VERT	HORZ	DOWN	HORZ
A	151	0	151	0
F	73	0	73	0
H	377	0	377	0
G	444	0	444	0
I	306	0	306	0
J	309	0	309	0

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	108	72/0	0/0	0/0	0/0	34/0	0/0
F	52	35/0	0/0	0/0	0/0	17/0	0/0
H	289	184/0	0/0	0/0	0/0	104/0	0/0
G	313	211/0	0/0	0/0	0/0	102/0	0/0
I	216	144/0	0/0	0/0	0/0	71/0	0/0
J	219	143/0	0/0	0/0	0/0	76/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, F, H, G, I, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-L	-15/0	-91.8	-91.8 0.02 (1)	H-D	-298/0	0.08 (1)	
L-B	-2/7	-91.8	-91.8 0.08 (1)	G-E	-389/0	0.08 (1)	
B-C	0/8	-91.8	-91.8 0.09 (1)	F-C	-274/0	0.04 (1)	
C-D	-12/4	-91.8	-91.8 0.18 (1)	J-B	-207/0	0.03 (1)	
D-E	-32/0	-91.8	-91.8 0.20 (1)	K-L	-105/0	0.00 (1)	
E-N	0/21	-91.8	-91.8 0.20 (1)	M-N	0/28	0.00 (1)	
N-F	-50/0	-91.8	-91.8 0.03 (1)				
A-K	-10/0	-18.5	-18.5 0.09 (1)				
K-J	-4/5	-18.5	-18.5 0.09 (1)				
J-I	-8/0	-18.5	-18.5 0.05 (1)				
I-H	-3/10	-18.5	-18.5 0.06 (4)				
H-G	-3/10	-18.5	-18.5 0.06 (4)				
G-M	0/35	-18.5	-18.5 0.05 (4)				
M-F	0/37	-18.5	-18.5 0.01 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
DL	=	6.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.20/1.00 (E-N:1), BC=0.09/1.00 (J-K:1), WB=0.08/1.00 (D-H:1), SSI=0.15/1.00 (D-E:1)

DDL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1687
	618	354	1687


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.27 (C) (INPUT = 0.30)
JSI METAL = 0.20 (E) (INPUT = 1.00)



Structural component only
DWG# T-2006986

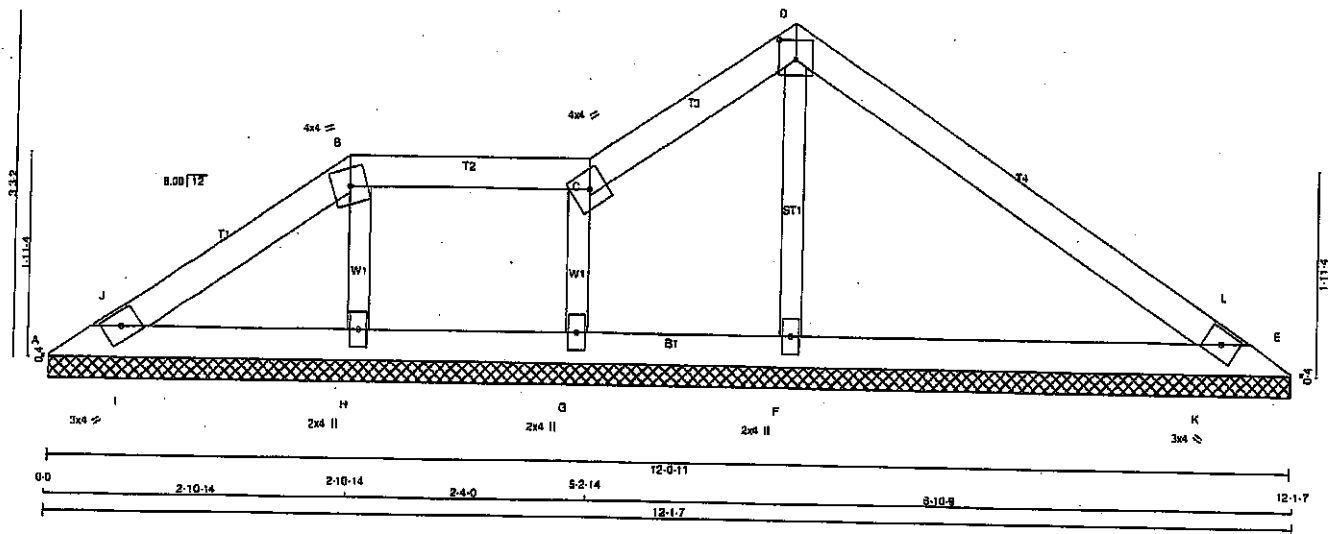

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
A - E	2x4	DRY	No.2

ALL WEBS 2x3 DRY
DRY: SEASONED LUMBER.

DESCR.
SPF
SPF
SPF
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
A	41	0	41	0	12-0-11	12-0-11
E	122	0	122	0	12-0-11	12-0-11
F	720	0	720	0	12-0-11	12-0-11
H	433	0	433	0	12-0-11	12-0-11
G	13	0	13	0	12-0-11	12-0-11

PROVIDE ANCHORAGE AT BEARING JOINT G FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LOASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	29	19/0	0/0	0/0	0/0	10/0	0/0
E	86	58/0	0/0	0/0	0/0	29/0	0/0
F	510	331/0	0/0	0/0	0/0	179/0	0/0
H	306	200/0	0/0	0/0	0/0	108/0	0/0
G	8	9/0	0/0	0/0	0/0	0/-1	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, F, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		MAX. FACTORED	WEBS	FACTORED	
	MAX. FORCE (LBS)	VERT. LOAD (PLF)	VERT. LOAD (PLF)	MAX. FORCE (LBS)			MAX. FORCE (LBS)	MAX. FORCE (LBS)
FR-TO								
A-J	0/212	-91.8	-91.8	0.04 (1)	10.00	F-D	-541/0	0.10 (1)
J-B	0/227	-91.8	-91.8	0.10 (1)	10.00	H-B	-329/0	0.05 (1)
B-C	0/210	-91.8	-91.8	0.12 (1)	10.00	G-C	-82/9	0.01 (1)
C-D	0/247	-91.8	-91.8	0.10 (1)	10.00	I-J	-101/0	0.00 (1)
D-L	0/242	-91.8	-91.8	0.27 (1)	10.00	K-L	-247/0	0.00 (1)
L-E	0/251	-91.8	-91.8	0.10 (1)	10.00			
A-I	-203/0	-18.5	-18.5	0.06 (1)	6.25			
I-H	-189/0	-18.5	-18.5	0.06 (1)	6.25			
H-G	-210/0	-18.5	-18.5	0.05 (1)	6.25			
G-F	-206/0	-18.5	-18.5	0.14 (1)	6.25			
F-K	-206/0	-18.5	-18.5	0.21 (1)	6.25			
K-E	-244/0	-18.5	-18.5	0.21 (1)	6.25			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.27/1.00 (D-L:1), BC=0.21/1.00 (F-K:1),
WB=0.10/1.00 (D-F:1), SS=0.15/1.00 (E-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.45 (D) (INPUT = 0.90)
JSI METAL= 0.18 (D) (INPUT = 1.00)

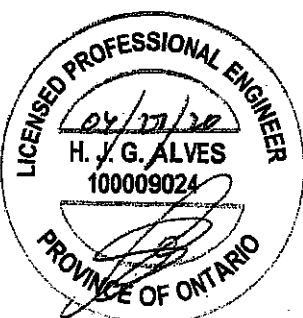


Structural component only
DWG# T-2006987

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408087	J1	21	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 9 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 08:53:11 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-BUQu4KZ0CY685uhquEMP543auqFkt_iH0aoSgzNEh6

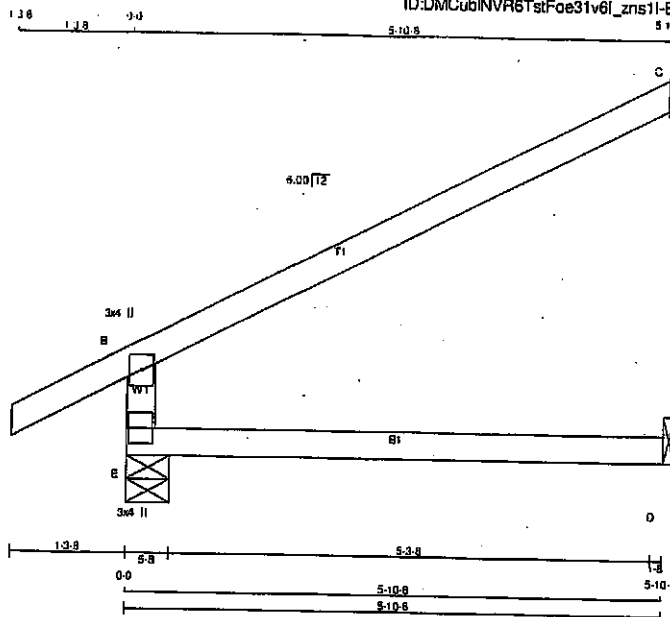

LUMBER	N.L.G.A. RULES	CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2		
A - C	2x4	DRY	No.2		
E - D	2x4	DRY	No.2		

DRY: SEASONED LUMBER.

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT		RECORD	
	VERT	HORZ	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
E	525	0	525	0	0	5-8	5-8	5-8
C	202	0	202	0	0	1-8	1-8	1-8
D	45	0	50	0	0	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LOUSE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	369	257/0	0/0	0/0	0/0	111/0	0/0
C	139	113/0	0/0	0/0	0/0	26/0	0/0
D	36	0/0	0/0	0/0	0/0	36/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			FACTORED			WEBS		
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (LBS)	LC1	MAX CS1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FORCE (LBS)	MAX CS1 (LC)
FR-TO		FROM TO				FR-TO		
E-B	-461/0	0.0	0.0	0.13 (4)	7.81			
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00			
B-C	-30/0	-91.8	-91.8	0.54 (1)	6.25			
E-D	0/0	-18.5	-18.5	0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 085-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4),
WB=0.00/1.00 (na:0), SSI=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (E) (INPUT = 0.90)
JSI METAL = 0.13 (B) (INPUT = 1.00)

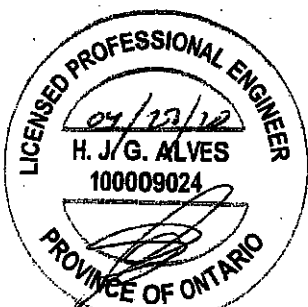

Structural component only
DWG# T-2006949

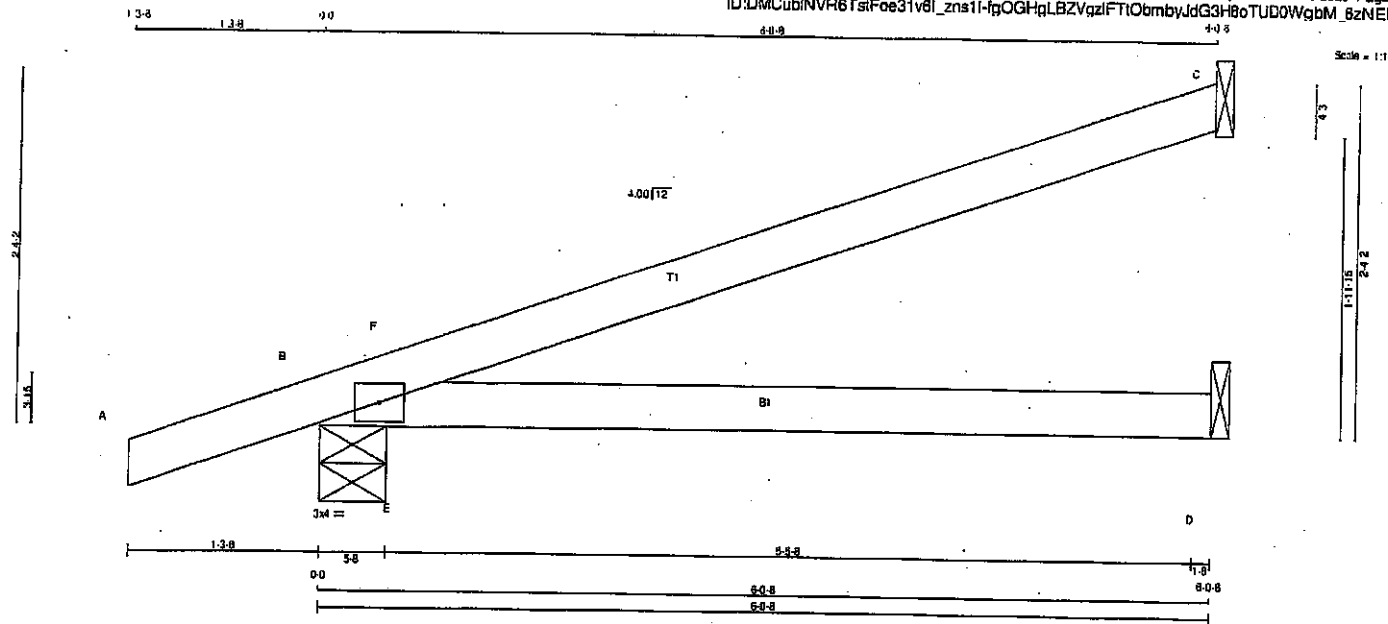

LUMBER
 N. L. G. A. RULES
 CHORDS SIZE LUMBER
 A - C 2x4 DRY No.2
 B - D 2x4 DRY No.2
 DRY: SEASONED LUMBER.

PLATES (tablets in inches)
 JT TYPE PLATES W LEN Y X
 B TMB1-1 MT20 3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
C	242	0	242	0	1-8	1-8		
B	456	0	456	0	5-8	5-8		
D	91	0	91	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	COMBINED	MAX. MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
C	188	131 / 0	0 / 0	0 / 0	0 / 0	37 / 0	0 / 0
B	320	223 / 0	0 / 0	0 / 0	0 / 0	97 / 0	0 / 0
D	68	24 / 0	0 / 0	0 / 0	0 / 0	44 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS		MAX. FACTORED	
	FR-TO	FORCE (LBS)	VERT. LOAD (PL)	LC1 MAX (PL)	MEMB. LENGTH FR-TO	UNBRACED E-F	FORCE (LBS)	MAX (PL)
A-B	0 / 18		-91.8	-91.8 0.11 (1)	10.00			
B-F	-20 / 22		-91.8	-91.8 0.06 (4)	6.25			
F-C	-2 / 2		-91.8	-91.8 0.43 (1)	10.00			
B-E	0 / 0		-18.5	-18.5 0.30 (1)	10.00			
E-D	0 / 0		-18.5	-18.5 0.30 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, CBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.20")
 CALCULATED VERT. DEFL. (LL) = $L/826$ (0.08")
 ALLOWABLE DEFL. (TL) = $L/360$ (0.20")
 CALCULATED VERT. DEFL. (TL) = $L/452$ (0.16")

CSI: TC=0.43/1.00 (C-F:1), BC=0.30/1.00 (D-E:1),
 WB=0.00/1.00 (E-F:1), SSI=0.29/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PL) (PL)
 MAX MIN MAX MIN MAX MIN
 MT20 519 354 1667 788 1987 1655


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.30 (B) (INPUT = 0.90)
 JSI METAL = 0.09 (B) (INPUT = 1.00)



Structural component only
 DWG# T-2006950

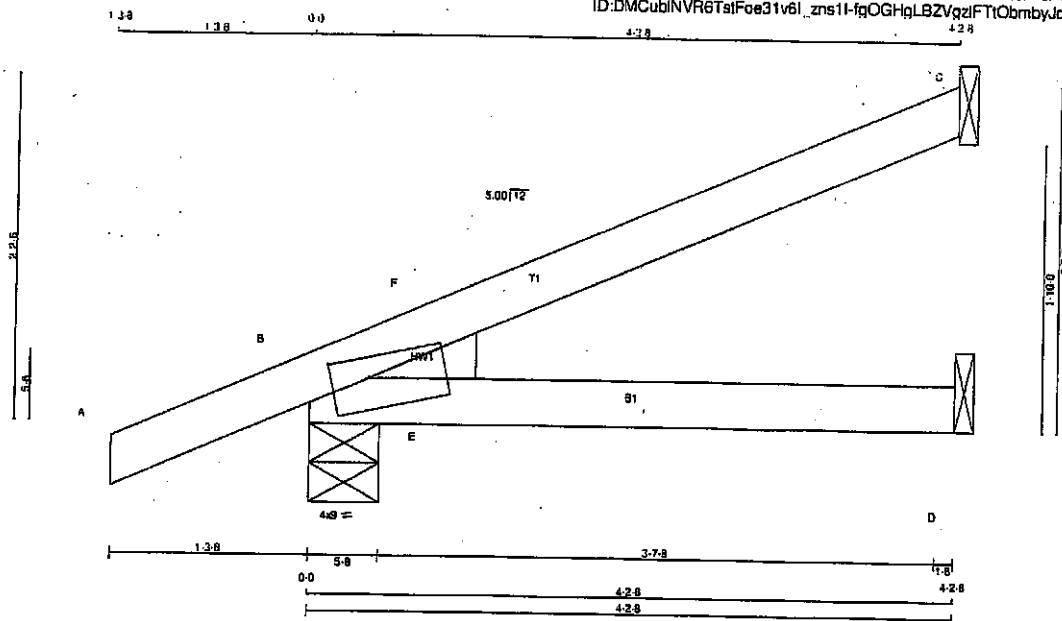

Scale = 1/12

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
B - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMBH1-m	MT20	4.0	9.0	1.50 3.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG	HEEL WEDGE
	VERT	HORZ	DOWN	HORZ			
C	164	0	164	0	1-8	1-8	
B	356	0	356	0	5-8	5-8	2x4 L
D	68	0	68	0	1-8	1-8	

SEE MTEK STANDARD DETAIL 897781H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
		COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
C	113	88/0	0/0	0/0	0/0	26/0	0/0
B	249	177/0	0/0	0/0	0/0	73/0	0/0
D	51	20/0	0/0	0/0	0/0	31/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 18	-91.8 -91.8	0.12 (1)	10.00	E-F	-151 / 4	0.00 (1)
B-F	-17 / 0	-91.8 -91.8	0.05 (4)	8.25			
F-C	0 / 3	-91.8 -91.8	0.20 (1)	10.00			
B-E	0 / 0	-18.5 -18.5	0.17 (1)	10.00			
E-D	0 / 0	-18.5 -18.5	0.17 (1)	10.00			

TOTAL WEIGHT = 5 X 13 = 63 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OSC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/260$ (0.19')
 CALCULATED VERT. DEFL. (LL) = $L/999$ (0.02')
 ALLOWABLE DEFL. (TL) = $L/260$ (0.19')
 CALCULATED VERT. DEFL. (TL) = $L/999$ (0.04')

CS1: TC=0.20/1.00 (C-F:1), BC=0.17/1.00 (B-E:1),
 WB=0.00/1.00 (E-F:1), SS=0.13/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618 354 1657 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.13 (B) (INPUT = 0.90)
 JSI METAL= 0.03 (B) (INPUT = 1.00)

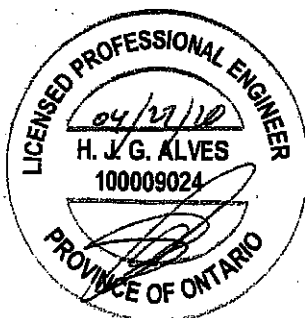


Structural component only
 DWG# T-2006951

JOB NAME 408088	TRUSS NAME J21	QUANTITY 5	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:03:30 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1t-Zaku_?qr0OXHvDjfbOrW7dDxiP7PG_D_dpl3gHzNEXR

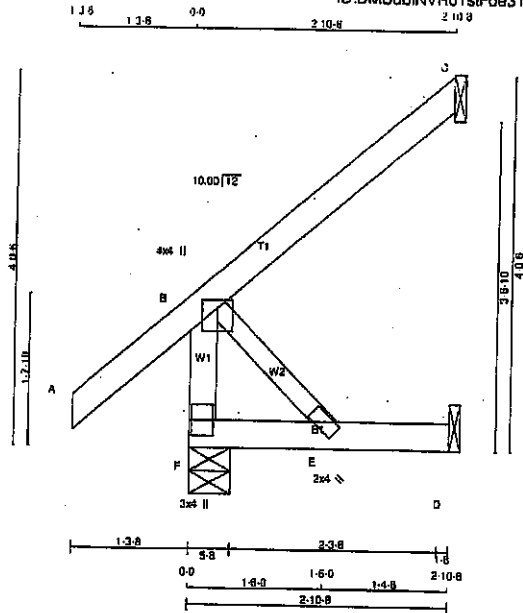

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
E	BMW+w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ
F	288	0	288	0
C	132	0	132	0
D	27	0	30	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
F	200	144 / 0	0 / 0	0 / 0	55 / 0	0 / 0
C	91	74 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	21	0 / 0	0 / 0	0 / 0	21 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
F-B	-259 / 0	0.0	0.0	0.03 (1)	7.81	B-E	0 / 0
A-B	0 / 41	-91.8	-91.8	0.13 (5)	10.00		0.00 (1)
B-C	0 / 0	-91.8	-91.8	0.13 (1)	10.00		
F-E	0 / 0	-18.5	-18.5	0.04 (4)	10.00		
E-D	0 / 0	-18.5	-18.5	0.04 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 5 X 13 = 63 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, OBC 2012, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.18")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.18")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.13/1.00 (A-B:5), BC=0.04/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SSI=0.08/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PLI)
(PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.20 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)

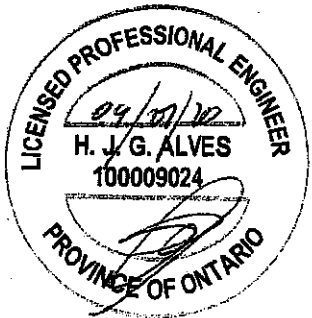

Structural component only
DWG# T-2006975

JOB NAME 408089	TRUSS NAME J30	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

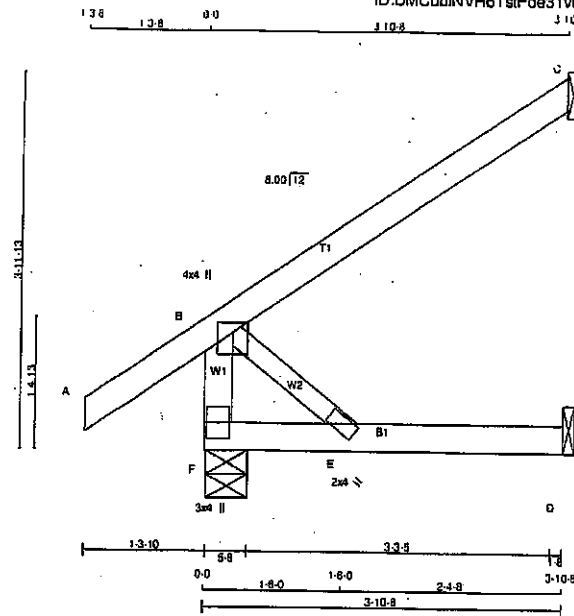

Version 8.31.0 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 09:25:35 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-GUto43sz_UTHMrVJ97EC2bMIXKqDEEOJTmqg_zNECK

Scale = 1/32"

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMVW+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
F	340	0	340	0	0	5-8	5-8
C	178	0	178	0	0	1-8	1-8
D	36	0	40	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LC CASE		MAX. MIN. COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	PERM. LIVE	WIND
F	238	169 / 0	0 / 0	0 / 0	0 / 0	68 / 0	0 / 0	0 / 0	0 / 0
C	122	99 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0	0 / 0	0 / 0
D	29	0 / 0	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		W E B S		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	LC1 MAX (LBS)	MEMB.	FORCE (LBS)	MAX (LBS)	LC1 (LBS)
FR-TO		FROM	TO	FR-TO			
F-B	-304 / 0	0.0	0.0	0.03 (1)	7.81	0 / 0	0.00 (1)
A-B	0 / 35	-91.8	-91.8	0.14 (5)	10.00		
B-C	0 / 0	-91.8	-91.8	0.23 (1)	10.00		
F-E	0 / 0	-18.5	-18.5	0.08 (4)	10.00		
E-D	0 / 0	-18.5	-18.5	0.08 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 14 = 28 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL = 6.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD = 39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) =	L/360 (0.19")
CALCULATED VERT. DEFL. (LL) =	L/999 (0.00")
ALLOWABLE DEFL. (TL) =	L/360 (0.19")
CALCULATED VERT. DEFL. (TL) =	L/999 (0.01")

CSI: TC=0.23/1.00 (B-C:1), BC=0.08/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MIN	MAX	MIN
MT20	618	354
	1887	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.21 (B) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006993

Tamarack Roof Truss, Burlington


Version 8.310 S Oct 29 2019 MifTek Industries, Inc. Sat Apr 25 09:25:38 2020 Page 1
ID:DMCubINVR6TslFoe31v6l_zns11-kgSBHOtlob8_74VGteTkF8Y?whmyhi9X7VECRzNFC



Structural component only
DWG# T-2006994

JSI GRIP= 0.21 (B) (INPUT = 0.80)
JSI METAL= 0.08 (G) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408089	J32	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:25:38 2020 Page 1					
ID:DMCubINVR6TatFoe31v6l zns1l-g3zxi4urHPsDJEuOlqpgDvTkNNOb S7R_LHJzNECh					
Scale = 1:22.5					

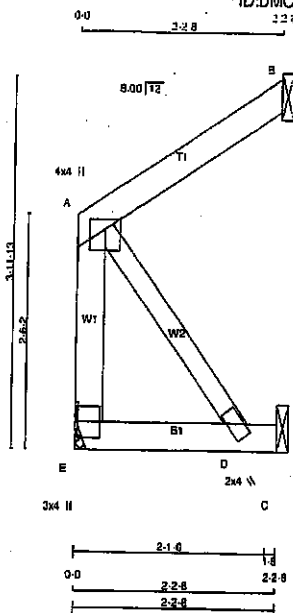

LUMBER				
N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - A	2x4	DRY	No.2	SPF
A - B	2x4	DRY	No.2	SPF
E - C	2x4	DRY	No.2	SPF
ALL WEBS 2x3 DRY No.2 SPF				
DRY: SEASONED LUMBER.				

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
A 7MVW+p	MT20	4.0	4.0	1.25 2.00
D 8MVW+p	MT20	2.0	4.0	
E 8MV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	HORIZ	UPLIFT	IN-SX	BRG	IN-SX
E	122	0	122	0	0	0	1-8	1-8	
B	101	0	101	0	0	0	1-8	1-8	
C	20	0	23	0	0	0	1-8	1-8	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS		MAX/MIN COMPONENT REACTIONS					
JT	1ST CASE	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
E	86	56/0	0/0	0/0	0/0	0/0	30/0
B	70	56/0	0/0	0/0	0/0	0/0	13/0
C	18	0/0	0/0	0/0	0/0	0/0	16/0

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED				WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1	MAX	MAX.	MEMB.	FORCE (LBS)	MAX	MAX
FR-TO		FROM TO				FR-TO			
E-A	-101/0	0.0	0.0	0.01 (1)	7.81	A-D	0/0	0.00 (1)	
A-B	0/0	-91.8	-91.8	0.08 (1)	10.00				
E-D	0/0	-18.5	-18.5	0.03 (4)	10.00				
D-C	0/0	-18.5	-18.5	0.02 (4)	10.00				

TOTAL WEIGHT = 4 X 10 = 41 lb (MIF)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19')
CALCULATED VERT. DEFL.(LL) = L/999 (0.00')
ALLOWABLE DEFL.(TL) = L/360 (0.19')
CALCULATED VERT. DEFL.(TL) = L/999 (0.00')

CSI: TC=0.08/1.00 (A-B:1), BC=0.03/1.00 (D-E:4),
WB=0.00/1.00 (A-D:1), SSI=0.07/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (FL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1657 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.07 (A) (INPUT = 0.90)
JSI METAL= 0.02 (A) (INPUT = 1.00)

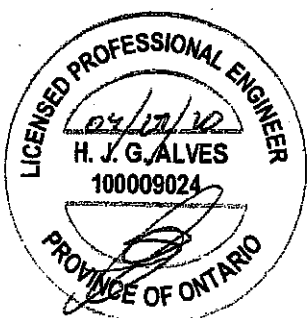

Structural component only
DWG# T-2006995

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408087	V01	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 08:53:26 2020 Page 1					
ID:DMCubINVR6TstFoe31v6I_zns1I-FNEZDTWzGpR_RPXaCX0tWFC7xyul64kr_5T1zNEgl					
Scale = 1:37.4					

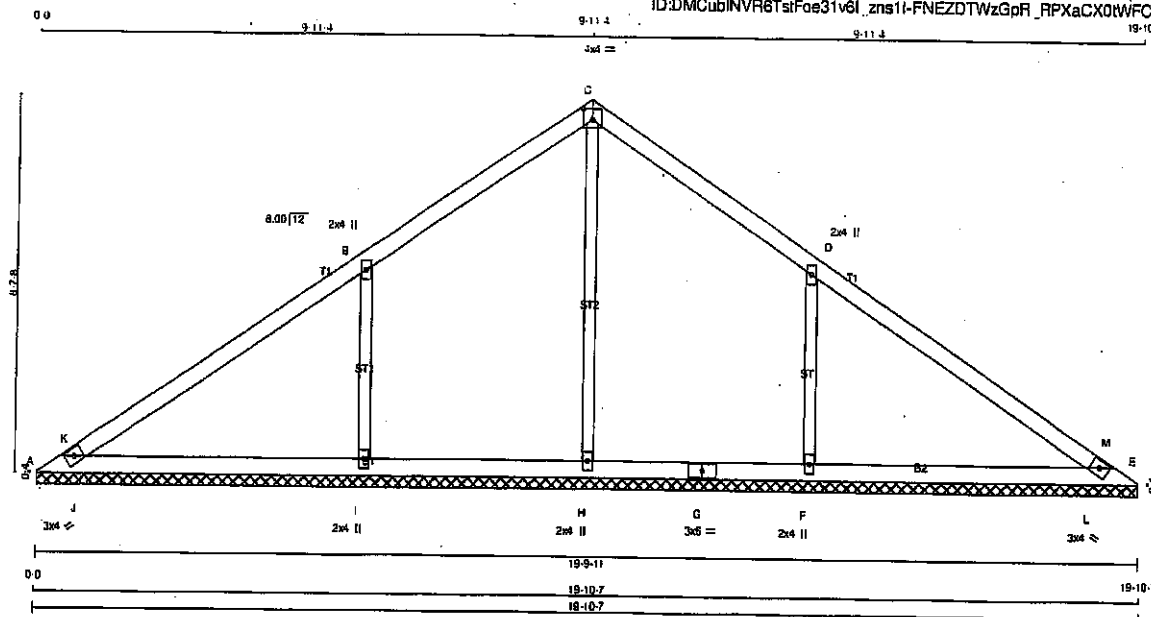

TOTAL WEIGHT = 59 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
A - G	2x4	DRY	No.2
G - E	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

DESCR.

SPF	SPF	SPF	SPF
SPF	SPF	SPF	SPF
SPF	SPF	SPF	SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
A	110	0	110	0	19-9-11 (7-8-1919-11	
E	110	0	110	0	19-9-11 (7-8-1919-11	
H	612	0	612	0	19-9-11 (7-8-1919-11	
I	676	0	676	0	19-9-11 (7-8-1919-11	
F	676	0	676	0	19-9-11 (7-8-1919-11	

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	77	54/0	0/0	0/0	0/0	24/0	0/0
E	77	54/0	0/0	0/0	0/0	24/0	0/0
H	435	274/0	0/0	0/0	0/0	161/0	0/0
I	478	316/0	0/0	0/0	0/0	161/0	0/0
F	478	316/0	0/0	0/0	0/0	161/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, H, I, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC1)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC1)	
FR-TO		FROM TO		FR-TO			
A-K	0/286	-91.8 -91.8	0.08 (1)	H-C	-597/0	0.42 (1)	
K-B	0/322	-91.8 -91.8	0.39 (1)	I-B	-516/0	0.13 (1)	
B-C	0/277	-91.8 -91.8	0.38 (1)	F-D	-516/0	0.13 (1)	
C-D	0/277	-91.8 -91.8	0.38 (1)	J-K	-205/7	0.00 (1)	
D-M	0/322	-91.8 -91.8	0.39 (1)	L-M	-205/7	0.00 (1)	
M-E	0/286	-91.8 -91.8	0.08 (1)				
A-J	-281/0	-18.5 -18.5	0.18 (1)				
J-I	-247/0	-18.5 -18.5	0.19 (1)				
I-H	-258/0	-18.5 -18.5	0.14 (1)				
H-G	-258/0	-18.5 -18.5	0.14 (1)				
G-F	-258/0	-18.5 -18.5	0.14 (1)				
F-E	-247/0	-18.5 -18.5	0.19 (1)				
E-D	-281/0	-18.5 -18.5	0.18 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.39/1.00 (D-M:1), BC=0.19/1.00 (F-L:1), WB=0.42/1.00 (G-H:1), SS=0.18/1.00 (D-M:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788
		1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.50 (C) (INPUT = 0.50)

JSI METAL = 0.26 (D) (INPUT = 1.00)



Structural component only
DWG# T-2006969

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408087	V02	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 08:53:27 2020 Page 1	

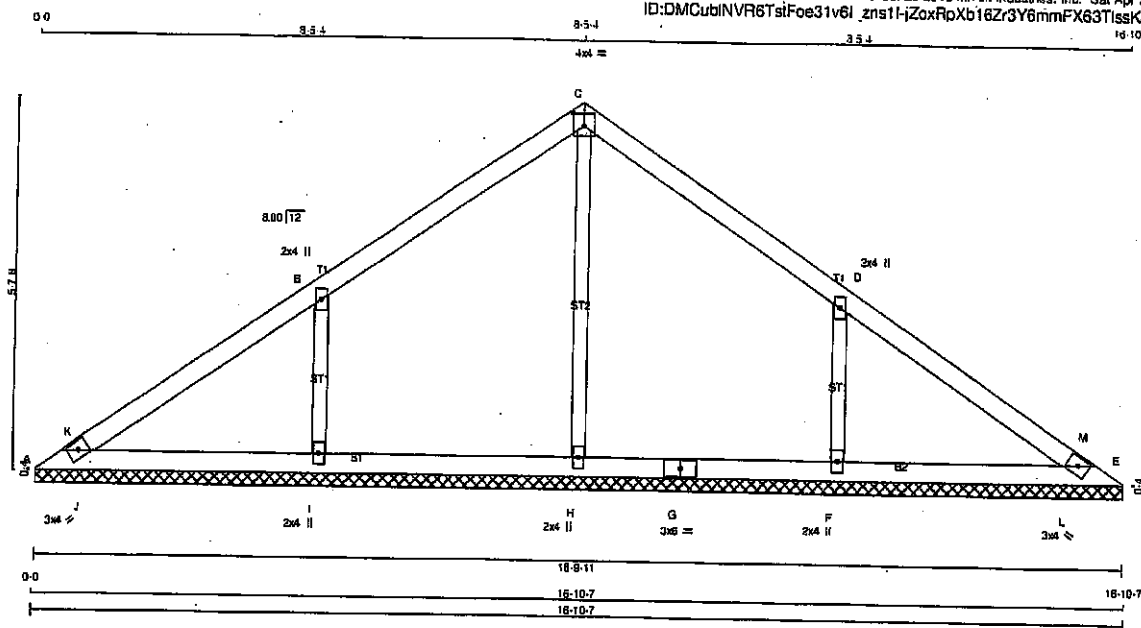

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
A - G	2x4	DRY	No.2
G - E	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TBM1-h	MT20	3.0	4.0	
B	TMW-w	MT20	2.0	4.0	
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TMW-w	MT20	2.0	4.0	
E	TBM1-h	MT20	3.0	4.0	
F, H, I					
F	BMW1-w	MT20	2.0	4.0	
G	BS-1	MT20	3.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
A	140	0	140	0	0	0	16-9-11 (8-9-10)9-11		
E	140	0	140	0	0	0	16-9-11 (8-9-10)9-11		
H	455	0	455	0	0	0	16-9-11 (8-9-10)9-11		
I	559	0	559	0	0	0	16-9-11 (8-9-10)9-11		
F	559	0	559	0	0	0	16-9-11 (8-9-10)9-11		

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

1ST CASE		MAX/MIN. COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	COMBINED	SNOW	LIVE	PERM. LIVE
A	98	68/0	0/0	0/0	0/0	31/0	0/0				
E	98	68/0	0/0	0/0	0/0	31/0	0/0				
H	325	198/0	0/0	0/0	0/0	127/0	0/0				
I	395	264/0	0/0	0/0	0/0	131/0	0/0				
F	395	264/0	0/0	0/0	0/0	131/0	0/0				

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, H, I, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		W E B S		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (LBS)	MEMB.	FORCE (LBS)	MAX. (LBS)	MAX. (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-K	0/73	-91.8	-91.8 0.04 (4)	10.00	H-C	-406/0	0.19 (1)
K-B	0/122	-91.8	-91.8 0.26 (1)	10.00	I-B	-440/0	0.08 (1)
B-C	0/83	-91.8	-91.8 0.26 (1)	10.00	F-D	-440/0	0.08 (1)
C-D	0/83	-91.8	-91.8 0.26 (1)	10.00	J-K	-103/6	0.00 (1)
D-M	0/122	-91.8	-91.8 0.26 (1)	10.00	L-M	-103/6	0.00 (1)
M-E	0/73	-91.8	-91.8 0.04 (4)	10.00			
A-J	-94/0	-18.5	-18.5 0.10 (1)	6.25			
J-I	-78/0	-18.5	-18.5 0.10 (1)	6.25			
I-H	-89/0	-18.5	-18.5 0.08 (4)	6.25			
H-G	-89/0	-18.5	-18.5 0.08 (4)	6.25			
G-F	-89/0	-18.5	-18.5 0.08 (4)	6.25			
F-L	-76/0	-18.5	-18.5 0.10 (1)	6.25			
L-E	-94/0	-18.5	-18.5 0.10 (1)	6.25			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.28/1.00 (D-M:1), BC=0.10/1.00 (F-L:1),
WB=0.19/1.00 (C-H:1), SS=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1856

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.34 (C) (INPUT = 0.90)
JSI METAL= 0.22 (B) (INPUT = 1.00)

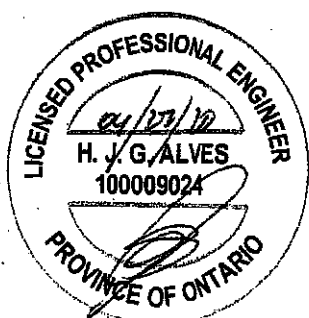

Structural component only
DWG# T-2006970

JOB NAME 408087	TRUSS NAME V03	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 08:53:28 2020 Page 1	

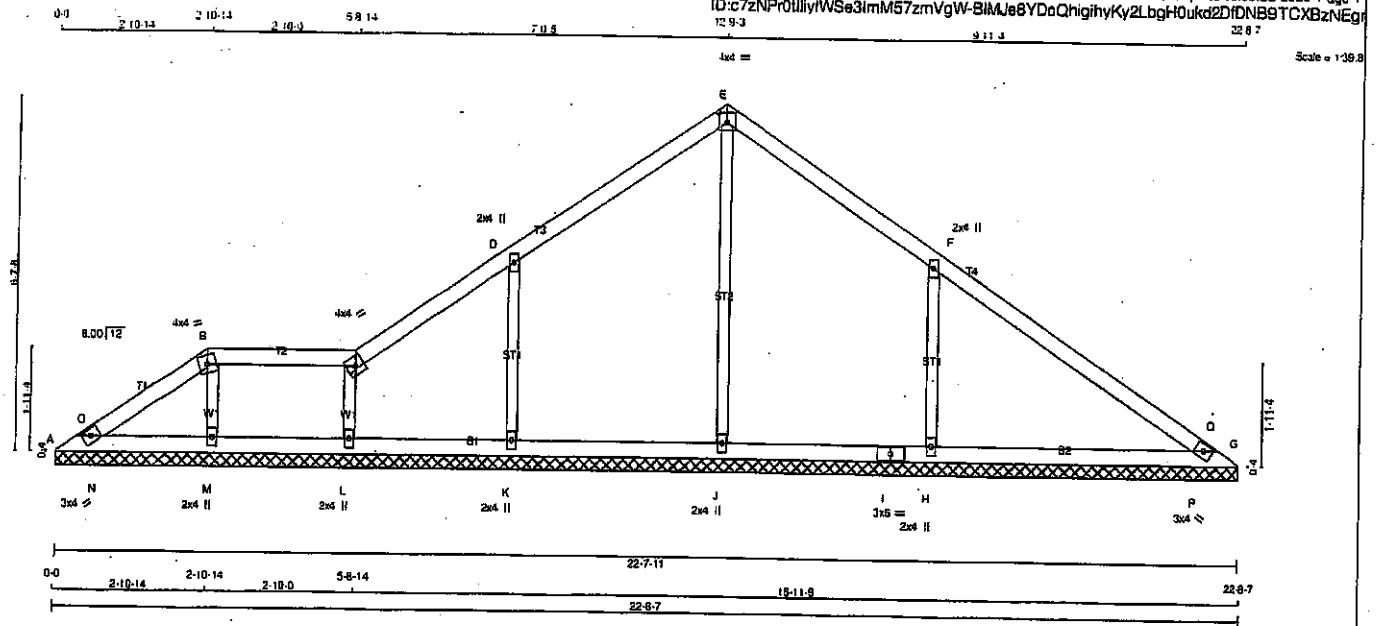

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF	
B - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
E - G	2x4	DRY	No.2	SPF	
A - I	2x4	DRY	No.2	SPF	
I - G	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B	TTW-m	MT20	4.0	4.0		
C	TTW-h	MT20	4.0	4.0		
D	TMW-w	MT20	2.0	4.0		
E	TTW-p	MT20	4.0	4.0	2.25	2.00
F	TMW-w	MT20	2.0	4.0		
G	TBM1-h	MT20	3.0	4.0		
H, J, K, L, M	BMW1-w	MT20	2.0	4.0		
I	BS-t	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
A	85	0	85	0	22-7-11 (15-1232-11)	
G	187	0	187	0	22-7-11 (15-1232-11)	
J	493	0	493	0	22-7-11 (15-1232-11)	
K	485	0	485	0	22-7-11 (15-1232-11)	
H	681	0	681	0	22-7-11 (15-1232-11)	
L	166	0	166	0	22-7-11 (15-1232-11)	
M	399	0	399	0	22-7-11 (15-1232-11)	

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	80	43/0	0/0	0/0	0/0	17/0	0/0
G	132	89/0	0/0	0/0	0/0	43/0	0/0
J	361	218/0	0/0	0/0	0/0	133/0	0/0
K	342	231/0	0/0	0/0	0/0	111/0	0/0
H	481	319/0	0/0	0/0	0/0	162/0	0/0
L	118	76/0	0/0	0/0	0/0	42/0	0/0
M	283	182/0	0/0	0/0	0/0	100/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, G, J, K, H, L, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. FACTORED CS1 (LC)	WEBS	
				MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)
FR-TO					
A-O	0/121	-91.8	-91.8 0.03 (1)	10.00	J-E -451/0 0.32 (1)
O-B	0/138	-91.8	-91.8 0.09 (1)	10.00	K-D -405/0 0.10 (1)
B-C	0/131	-91.8	-91.8 0.15 (1)	10.00	H-F -521/0 0.13 (1)
C-D	0/176	-91.8	-91.8 0.24 (1)	10.00	L-C -132/0 0.02 (1)
D-E	0/138	-91.8	-91.8 0.23 (1)	10.00	M-S -304/0 0.04 (1)
E-F	0/124	-91.8	-91.8 0.37 (1)	10.00	N-O -101/0 0.00 (1)
F-G	0/172	-91.8	-91.8 0.37 (1)	10.00	P-Q -205/6 0.00 (1)
Q-G	0/138	-91.8	-91.8 0.06 (4)	10.00	
A-N	-128/0	-18.5	-18.5 0.07 (1)	6.25	
N-M	-112/0	-18.5	-18.5 0.07 (1)	6.25	
M-L	-131/0	-18.5	-18.5 0.05 (1)	6.25	
L-K	-123/0	-18.5	-18.5 0.06 (4)	6.25	
K-J	-132/0	-18.5	-18.5 0.08 (4)	6.25	
J-I	-132/0	-18.5	-18.5 0.14 (1)	6.25	
I-H	-132/0	-18.5	-18.5 0.14 (1)	6.25	
H-P	-120/0	-18.5	-18.5 0.21 (1)	6.25	
P-G	-156/0	-18.5	-18.5 0.21 (1)	6.25	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.37/1.00 (F-Q:1), BC=0.21/1.00 (H-P:1), WB=0.32/1.00 (E-J:1), SS=0.18/1.00 (F-Q:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.66 (C) (INPUT = 0.90)
JSI METAL= 0.27 (F) (INPUT = 1.00)



Structural component only
DWG# T-2006971

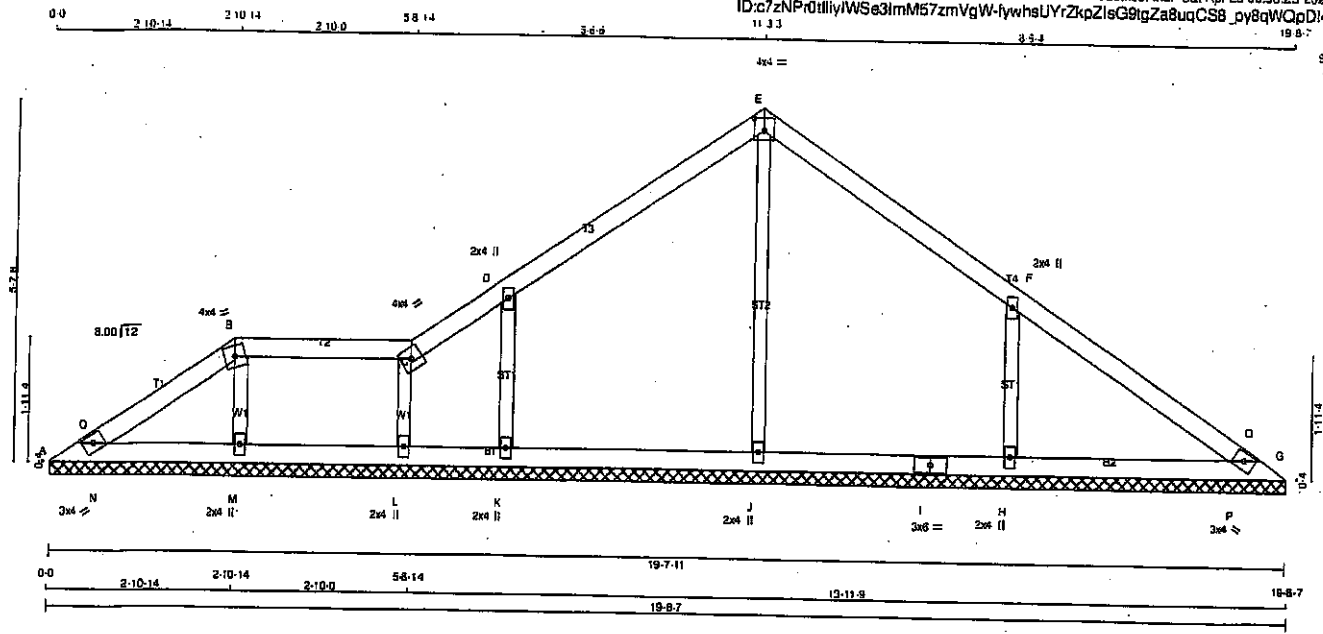

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
A - B	2x4	DRY No.2
B - C	2x4	DRY No.2
C - E	2x4	DRY No.2
E - G	2x4	DRY No.2
A - I	2x4	DRY No.2
I - G	2x4	DRY No.2

ALL WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
A - TBM1-h	MT20	3.0	4.0		
B - TTW-m	MT20	4.0	4.0		
C - TTW-h	MT20	4.0	4.0		
D - TMM-w	MT20	2.0	4.0	2.25	2.00
E - TTW-p	MT20	4.0	4.0		
F - TMM-w	MT20	2.0	4.0		
G - TBM1-h	MT20	3.0	4.0		
H - J, K, L, M	MT20	2.0	4.0		
I - BS-t	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG. IN-SX	RECORD BRG. IN-SX
	VERT	HORZ	DOWN	HORZ		
A	133	0	133	0	19-7-11 (13-11) 2-11	
G	164	0	164	0	19-7-11 (13-11) 2-11	
J	422	0	422	0	19-7-11 (13-11) 2-11	
K	451	0	451	0	19-7-11 (13-11) 2-11	
H	560	0	560	0	19-7-11 (13-11) 2-11	
L	78	0	78	0	19-7-11 (13-11) 2-11	
M	357	0	357	0	19-7-11 (13-11) 2-11	

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	COMBINED	MAX. MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	93	88/0	0/0	0/0	0/0	27/0	0/0
G	116	78/0	0/0	0/0	0/0	38/0	0/0
J	301	184/0	0/0	0/0	0/0	118/0	0/0
K	317	219/0	0/0	0/0	0/0	99/0	0/0
H	395	264/0	0/0	0/0	0/0	131/0	0/0
L	56	34/0	0/0	0/0	0/0	22/0	0/0
M	253	161/0	0/0	0/0	0/0	92/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, G, J, K, H, L, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	LC1 (PLF)	MAX. FACTORED CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM	TO			FR-TO			
A-O	0/22	-91.8	-91.8	0.02 (1)	10.00	J-E	-359/0	0.17 (1)	
O-B	0/34	-91.8	-91.8	0.08 (1)	10.00	K-D	-382/0	0.07 (1)	
B-C	0/41	-91.8	-91.8	0.13 (1)	10.00	H-F	-442/0	0.08 (1)	
C-D	0/99	-91.8	-91.8	0.21 (1)	10.00	L-C	-72/0	0.01 (1)	
D-E	0/39	-91.8	-91.8	0.20 (1)	10.00	M-B	-269/0	0.04 (1)	
E-F	0/34	-91.8	-91.8	0.25 (1)	10.00	N-O	-105/0	0.00 (1)	
F-Q	0/74	-91.8	-91.8	0.28 (1)	10.00	P-Q	-103/0	0.00 (1)	
Q-G	0/26	-91.8	-91.8	0.04 (4)	10.00				
A-N	-40/0	-18.5	-18.5	0.09 (1)	6.25				
N-M	-28/0	-18.5	-18.5	0.09 (1)	6.25				
M-L	-41/0	-18.5	-18.5	0.05 (1)	6.25				
L-K	-37/0	-18.5	-18.5	0.05 (4)	6.25				
K-J	-49/0	-18.5	-18.5	0.05 (4)	6.25				
J-I	-49/0	-18.5	-18.5	0.08 (4)	6.25				
I-H	-49/0	-18.5	-18.5	0.08 (4)	6.25				
H-P	-35/0	-18.5	-18.5	0.11 (1)	6.25				
P-G	-53/0	-18.5	-18.5	0.11 (1)	6.25				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.28/1.00 (F-Q:1), BC=0.11/1.00 (H-P:1), WB=0.17/1.00 (E-J:1), SS=0.15/1.00 (E-F:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.66 (C) (INPUT = 0.90)
JSI METAL= 0.23 (F) (INPUT = 1.00)

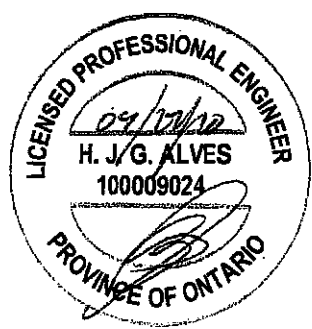

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408087	V05	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Sat Apr 25 08:53:29 2020 Page 1					
ID:c7zNPrt0tliiyWSe3ImM57zmVgW-fywhsUYrZkpZIs9t9Za8uqDW8_4y9tWQpD14dzNEgg					

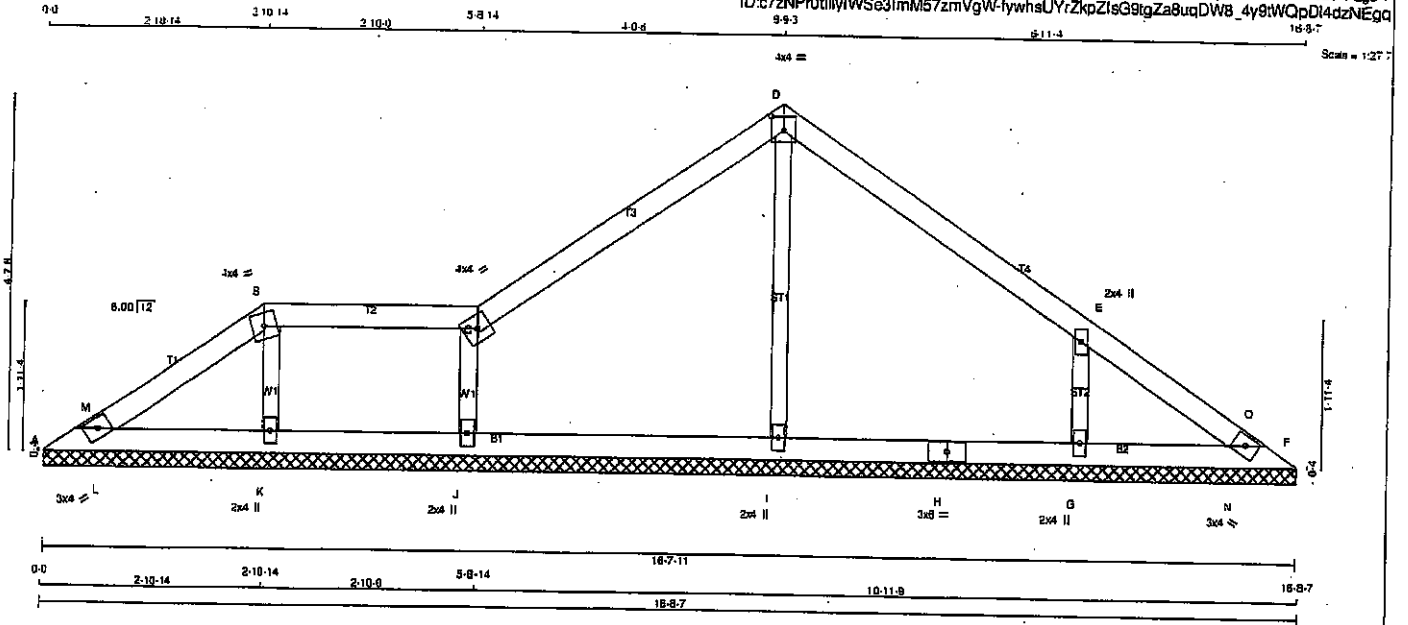

LUMBER				DESIGN CRITERIA			
N. L. G. A. RULES				SPECIFIED LOADS:			
CHORDS	SIZE	LUMBER	DESCR.	TOP CH.	LL	25.6	PSF
A - B	2x4	DRY	No.2	DL	6.0	PSF	
B - C	2x4	DRY	No.2	BOT CH.	LL	0.0	PSF
C - D	2x4	DRY	No.2	DL	7.4	PSF	
D - F	2x4	DRY	No.2	TOTAL LOAD	39.0	PSF	
A - H	2x4	DRY	No.2				
H - F	2x4	DRY	No.2				
ALL WEBS	2x3	DRY	No.2	SPACING = 24.0 IN. C/C			
DRY: SEASONED LUMBER.				LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12			

PLATES (tablets in inches)				
JT TYPE	PLATES	W	LEN	Y X
A TBM1-h	MT20	3.0	4.0	
B TTW-m	MT20	4.0	4.0	
C TTW-h	MT20	4.0	4.0	
D TTW-p	MT20	4.0	4.0	2.25 2.00
E TWW-w	MT20	2.0	4.0	
F TBM1-h	MT20	3.0	4.0	
G, I, J, K				
G BMMW1-w	MT20	2.0	4.0	
H BS-t	MT20	3.0	8.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG		
A	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
F	148	0	148	0	0	16-7-11 (11-118-2-1)			
I	109	0	109	0	0	16-7-11 (11-118-2-1)			
G	409	0	409	0	0	16-7-11 (11-118-2-1)			
J	486	0	486	0	0	16-7-11 (11-118-2-1)			
K	389	0	389	0	0	16-7-11 (11-118-2-1)			
	333	0	333	0	0	16-7-11 (11-118-2-1)			

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS							
JT	1ST LOASE	MAX. MIN. COMPONENT REACTIONS					
A	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	104	71 / 0	0 / 0	0 / 0	0 / 0	33 / 0	0 / 0
I	77	52 / 0	0 / 0	0 / 0	0 / 0	25 / 0	0 / 0
G	291	179 / 0	0 / 0	0 / 0	0 / 0	113 / 0	0 / 0
J	328	222 / 0	0 / 0	0 / 0	0 / 0	107 / 0	0 / 0
K	261	173 / 0	0 / 0	0 / 0	0 / 0	88 / 0	0 / 0
	235	155 / 0	0 / 0	0 / 0	0 / 0	81 / 0	0 / 0


BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, F, I, G, J, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH FR-TO	FR-TO			
A-M	-8 / 1	-91.8 -91.8	0.02 (1)	I-D	-329 / 0	0.10 (1)	
M-B	0 / 10	-91.8 -91.8	0.08 (1)	G-E	-392 / 0	0.08 (1)	
B-C	0 / 15	-91.8 -91.8	0.13 (1)	J-C	-319 / 0	0.05 (1)	
C-D	-6 / 7	-91.8 -91.8	0.25 (1)	K-B	-234 / 0	0.03 (1)	
D-E	-26 / 3	-91.8 -91.8	0.20 (1)	L-M	-104 / 0	0.00 (1)	
E-O	0 / 19	-91.8 -91.8	0.21 (1)	N-O	-8 / 7	0.00 (1)	
O-F	-43 / 0	-91.8 -91.8	0.04 (1)				
A-L	-16 / 0	-18.5 -18.5	0.09 (1)				
L-K	-6 / 0	-18.5 -18.5	0.09 (1)				
K-J	-15 / 0	-18.5 -18.5	0.05 (1)				
J-I	-6 / 5	-18.5 -18.5	0.07 (4)				
I-H	-6 / 5	-18.5 -18.5	0.07 (4)				
H-G	-6 / 5	-18.5 -18.5	0.07 (4)				
G-N	-2 / 25	-18.5 -18.5	0.05 (4)				
N-F	-3 / 22	-18.5 -18.5	0.03 (1)				

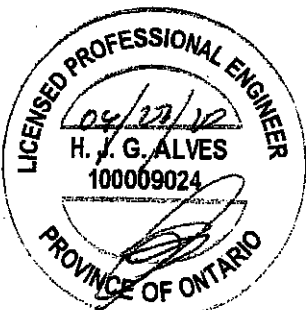

Structural component only
DWG# T-2006973

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.31 (C) (INPUT = 0.90)
JSI METAL = 0.20 (E) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408089	C30	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 09:25:30 2020 Page 1					
ID:DMCubINVR6TstFoe31v6I_zns11-vWUv1Laq9yr_G4dLwcX2V_uVBWcuY_?G8B2v?nzNECp					
Scale = 1:17.5					

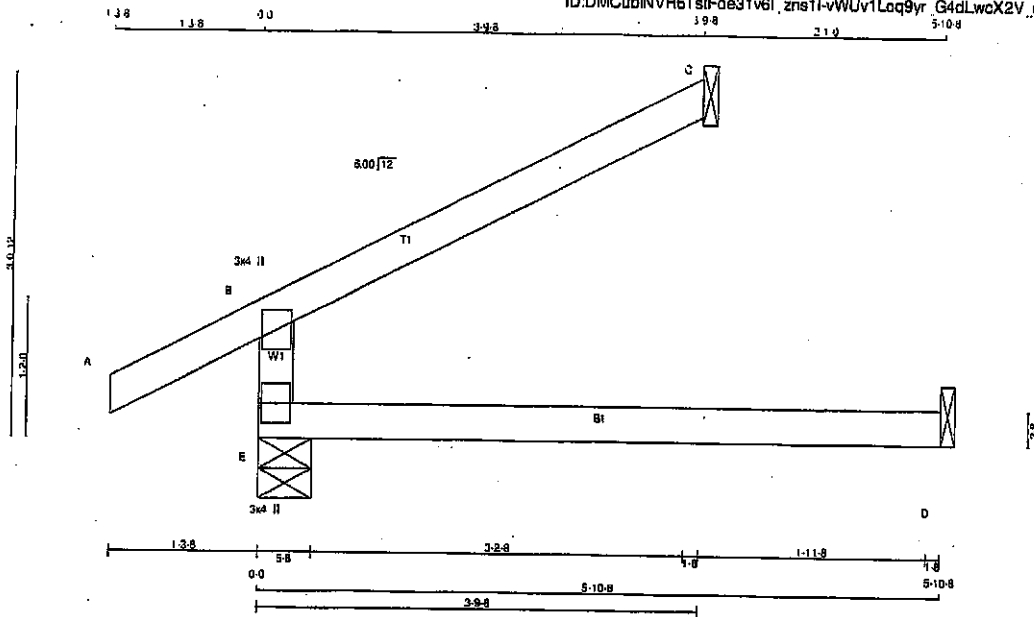

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER
E - B 2x4 DRY No.2
A - C 2x4 DRY No.2
E - D 2x4 DRY No.2
DRY: SEASONED LUMBER.

PLATES (table is in inches)
JT TYPE PLATES W LEN Y X
B TMV+p MT20 3.0 4.0
E BMV1+p MT20 3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECORD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	406	0	406	0	5-8	5-8
C	131	0	131	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN COMPONENT REACTIONS					
		COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
E	288	191/0	0/0	0/0	0/0	0/0	95/0
C	90	73/0	0/0	0/0	0/0	0/0	17/0
D	36	0/0	0/0	0/0	0/0	0/0	38/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED				WEBS			
	MAX. FACTORED FORCE (LBS)	VERT. LOAD (LBS)	VERT. LOAD (LBS)	LC1 MAX	CS1 (LC)	UNBRAC LENGTH	MEMB. FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	CS1 (LC)
FR-TO			FROM TO							
E-B	-342/0	0.0	0.0	0.13 (4)	7.81					
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00					
B-C	-19/0	-91.8	-91.8	0.22 (1)	6.25					
E-D	0/0	-18.5	-18.5	0.13 (4)	10.00					

TOTAL WEIGHT = 3 X 14 = 42 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2010, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.20")
CALCULATED VERT. DEFL.(LL) = L/899 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/899 (0.03")

CSI: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	818	354	1667 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP=0.14 (E) (INPUT = 0.90)
JSI METAL=0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006988

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408089	C31	3	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 09:25:31 2020 Page 1
ID:DMCubINVR6TstFoe31v6l zns11-Ni2IEhpSwGzrtECYTJ211CRiYy1HRFQOrTXDzNECC

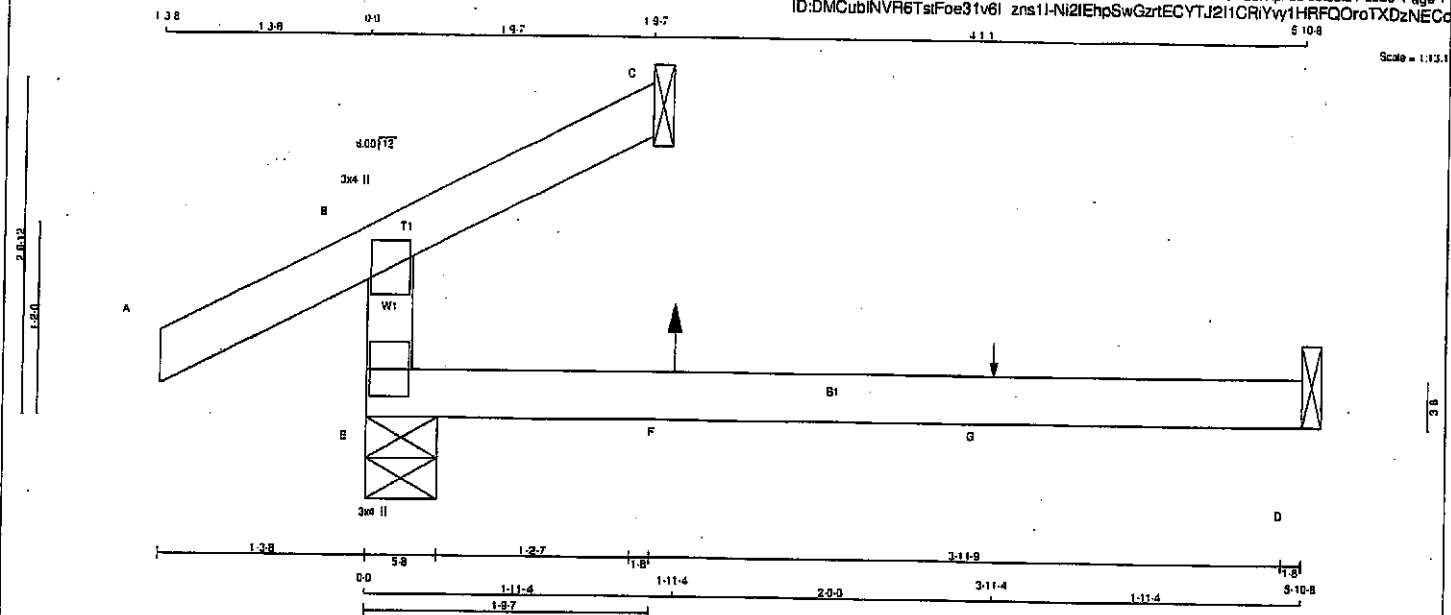

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
E BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	BRG	REORD
E	284	0	284	0	0	5-8	5-8
C	63	0	63	0	0	1-8	1-8
D	44	0	52	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	200	137 / 0	0 / 0	0 / 0	0 / 0	62 / 0	0 / 0
C	48	21 / 0	0 / 0	0 / 0	0 / 0	25 / 0	0 / 0
D	35	0 / 3	0 / 0	0 / 0	0 / 0	37 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (7)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (CS)	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH
FR-TO							FR-TO		
E-B	-227 / 0	0.0	0.0	0.11 (4)	7.81				
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00				
B-C	-9 / 9	-91.8	-91.8	0.08 (4)	10.00				
E-F	0 / 0	-18.5	-18.5	0.14 (4)	10.00				
F-G	0 / 0	-18.5	-18.5	0.14 (4)	10.00				
G-D	0 / 0	-18.5	-18.5	0.14 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR	TYPE	HEEL	CONN.
F	1-11.4	7	1	12	FRONT	VERT	TOTAL	-	C1
G	3-11.4	1	1	-	FRONT	VERT	TOTAL	-	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 3 X 12 = 35 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL = 8.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD = 39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, NBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01")
ALLOWABLE DEFL. (TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.04")

CSI: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4),
WB=0.00/1.00 (N/A:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=0.99 NAIL=0.99 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR SECTION (PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1687 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006989

JOB NAME 408089	TRUSS NAME C32	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 3.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:25:32 2020 Page 1
ID:DMCubiNVR6TstFoe31v6l_zns1l-svogS1q4hZ5iVOnk11ZXaPziJK90iUzCvX03fzNECn

Scale = 1:12.5

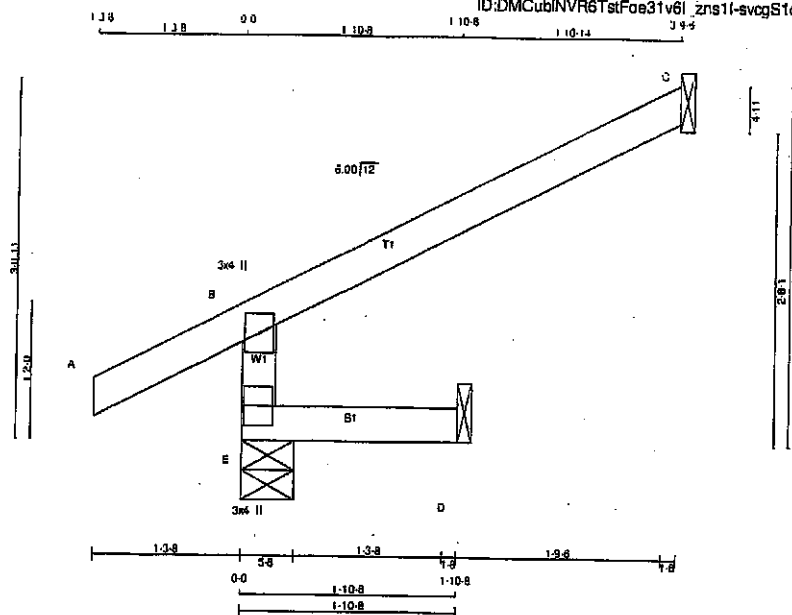

LUMBER			
N.L.G.A. RULES	SIZE	DRY	LUMBER
CHORDS	2x4	DRY	No.2
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
E BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
E		361	0	361	0	5-8	5-8		
C		130	0	130	0	1-8	1-8		
D		16	0	17	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
JT	1ST LCASE	MAX	MIN	COMPONENT REACTIONS			
E	COMBINED	250	190 / 0	0 / 0	0 / 0	0 / 0	0 / 0
C		90	73 / 0	0 / 0	0 / 0	0 / 0	0 / 0
D		12	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB. MAX. FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO	UNBRAC LENGTH	FR-TO
E-B	-341 / 0	0.0	0.0	0.01 (4)	7.81
A-B	0 / 28	-91.8	-91.8	0.13 (5)	10.00
B-C	-19 / 0	-91.8	-91.8	0.22 (1)	6.25
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 10 = 29 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. LC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TO=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 769 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP = 0.14 (B) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)

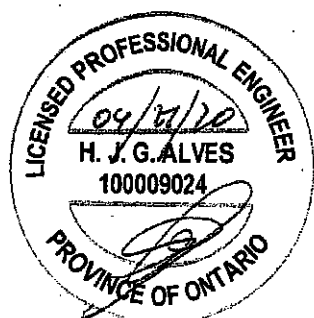

Structural component only
DWG# T-2006990

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408089	C33	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:25:33 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-K5A2InnSIDZ7XMwbk4m7dW22jg3IKjr9HAb6zNECm

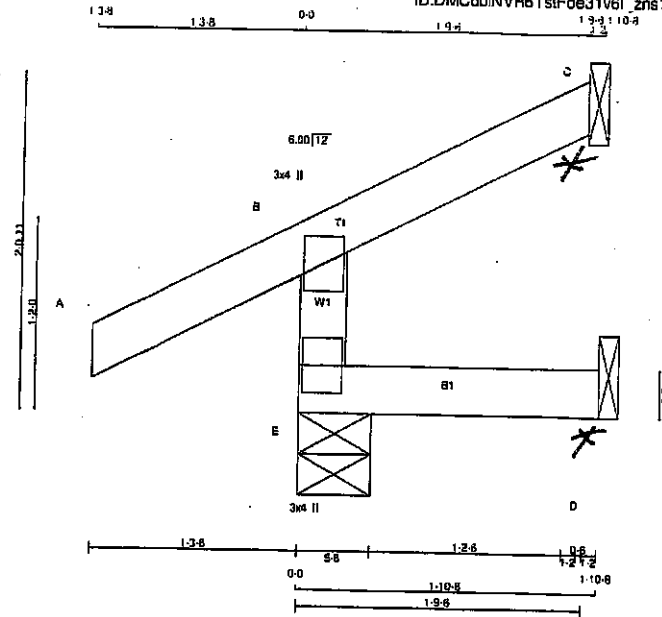

LUMBER

N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REORD BRG
	VERT	HORZ	DOWN	HORZ		
E	271	0	271	0	5-8	5-8
C	44	0	44	0	1-8	1-8
D	8	0	17	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E C D	188	141 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0
	31	24 / -18	0 / 0	0 / 0	0 / 0	7 / 0	0 / 0
	7	0 / -8	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED UNBRACED LENGTH FR-TO
E-B	-244 / 0	0.0	0.0	0.04 (5)
A-B	0 / 28	-91.8	-91.8	0.12 (1)
B-C	-17 / 0	-91.8	-91.8	0.09 (1)
E-D	0 / 0	-18.5	-18.5	0.04 (5)

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 7 = 21 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/989$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/989$ (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5),
WB=0.00/1.00 (na:0), SS=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MT20	618	354
	1687	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)

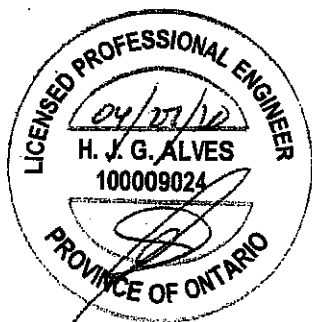

Structural component only
DWG# T-2006991

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.




Double-Shear Nailing Top View




Double-Shear Nailing Side View; Do not bend tab




Double-Shear Nailing Side View (available on some models) U.S. Patent 5,803,560

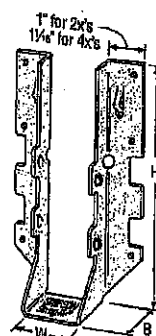


LUS28




LU26L

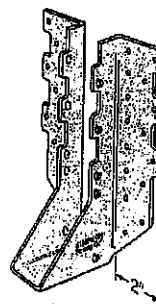


HUS210
(HUS26, HUS28, and HHUS similar)



HGUS28-2




HHUS210-2



LJS26DS

Typical HUS26 Installation with Reduced Heel Height
(Truss Designer to provide fastener quantity for connecting multiple members together)

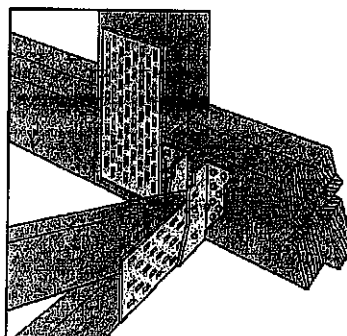

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS

HHUS/HGUS

See Hanger Options Information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
$W < 2"$	Bevel or square cut	0.62 of table value	0.46 of table value
$2" < W < 6"$	Bevel cut	0.67 of table value	0.41 of table value
$2" < W < 6"$	Square cut	0.46 of table value	0.41 of table value
$W > 6"$	Bevel cut	0.75 of table value	0.41 of table value

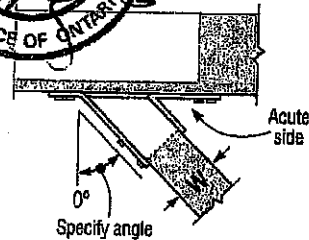

Top View HHUS Hanger Skewed Right
(joist must be bevel cut)
All joist nails installed on the outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ³	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN	(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN
Single 2x Sizes											
LUS24	18	1 1/8	3 1/8	1 1/4	2 1/4	(4) 10d	(2) 10d	710 316	1625 723	645 287	1155 514
LU24L	22	1 1/8	3	1 1/4	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360 1.60	1020 4.54	320 1.42	725 3.22
LU26L	22	1 1/8	5	1 1/4	4 1/8	(6) 10d	(4) 10d x 1 1/2"	720 3.20	1605 7.14	645 2.87	1140 5.07
LUS26	18	1 1/8	4 1/4	1 1/4	3 3/4	(4) 10d	(4) 10d	1420 6.32	2170 9.65	1290 5.74	1630 7.25
HUS26	16	1 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	2705 11.80	4940 21.97	2065 9.20	3675 17.24
LJS26DS	18	1 1/8	5	3 1/2	4 1/8	(16) 16d	(6) 16d	2055 9.14	4265 18.97	1460 6.49	4115 18.31
HGUS26	12	1 1/8	5 1/8	5	4 1/8	(20) 16d	(8) 16d	2685 11.96	6625 29.51	2685 11.96	5700 25.35
LU28L	20	1 1/8	6 1/8	1 1/4	5 1/8	(8) 10d	(6) 10d x 1 1/2"	1140 5.07	2185 9.72	1020 4.54	1550 6.89
LUS28	18	1 1/8	6 1/8	1 1/4	3 3/4	(6) 10d	(4) 10d	1420 6.32	2520 11.21	1290 5.74	1790 7.96
HUS28	16	1 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3605 16.04	5365 23.86	2675 11.90	4345 19.33
HGUS28	12	1 1/8	7 1/8	5	6 1/8	(36) 16d	(12) 16d	3310 14.74	7675 34.19	3310 14.74	6900 30.73
LU210L	20	1 1/8	8	1 1/4	7 1/8	(10) 10d	(6) 10d x 1 1/2"	1140 5.07	2495 11.10	1020 4.54	1770 7.87
LUS210	18	1 1/8	7 1/8	1 1/4	3 3/4	(8) 10d	(4) 10d	1420 6.32	2785 12.39	1290 5.74	2210 9.83

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.

2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.

3. d_g is the distance from the bearing seat to the top joist nail.

4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.

5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _o ³	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb.	(K _D = 1.00) lb.	(K _D = 1.15) lb.	(K _D = 1.00) lb.
								kN	kN	kN	kN
Double 2x Sizes											
LUS24-2	18	3 1/8	3 1/8	2	1 1/2	(4) 16d	(2) 16d	835	2020	590	1435
LUS26-2	18	3 1/8	4 1/8	2	4	(4) 16d	(4) 16d	3.71	8.99	2.62	6.38
HHUS26-2	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	1720	2595	1545	1920
HGUS26-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	7.65	11.54	6.87	8.64
LUS28-2	18	3 1/8	7	2	4	(6) 16d	(4) 16d	2850	7335	2065	5205
HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	12.68	32.83	9.20	23.15
HGUS28-2	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	4385	8950	3110	6355
LUS210-2	18	3 1/8	9	2	6	(8) 16d	(8) 16d	19.51	39.81	13.83	28.27
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d	1720	3325	1545	2575
HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	7.65	14.79	6.87	11.45
								3765	8940	2675	6345
								16.75	39.77	11.90	28.22
								6070	12980	4310	9215
								27.00	57.74	19.17	40.99
LUS210-2	18	3 1/8	9	2	6	(8) 16d	(8) 16d	2580	4500	2320	3195
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d	11.48	20.02	10.32	14.21
HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	4670	9660	4235	7000
								20.77	42.97	18.84	31.14
								6840	14015	4855	10270
								30.43	62.34	21.60	45.69
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/2	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-3	12	4 1/8	7 1/2	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	4670	9670	4235	6865
								20.77	43.02	18.84	30.54
HGUS210-3	12	4 1/8	9 1/4	4	8 3/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
Quadruple 2x Sizes											
HGUS26-4	12	6 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-4	14	8 1/8	8 1/8	3	7 3/8	(30) 16d	(10) 16d	4670	10155	4235	7210
								20.77	45.17	18.84	32.07
HGUS210-4	12	6 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
HGUS212-4	12	8 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10645
								33.98	88.70	24.13	47.35
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80
4x Sizes											
LUS46	18	3 1/8	4 1/8	2	3 3/8	(4) 16d	(4) 16d	1720	2595	1545	1920
								7.65	11.54	6.87	8.64
HHUS46	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	2540	7335	2065	5205
								11.30	32.83	9.20	23.15
HGUS46	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
LUS48	18	3 1/8	6 1/8	2	3 3/8	(6) 16d	(4) 16d	1720	3325	1545	2575
								7.65	14.79	6.87	11.45
HHUS48	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765	8940	2675	6345
								16.75	39.77	11.90	28.22
HGUS48	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
LUS410	18	3 1/8	8 1/8	2	5 1/8	(8) 16d	(8) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HGUS410	12	3 1/8	9	4	8 1/8	(46) 16d	(16) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
HGUS412	12	3 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10645
								33.98	66.70	24.13	47.35
HGUS414	12	3 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:

- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.


Optional TC Installation:

- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

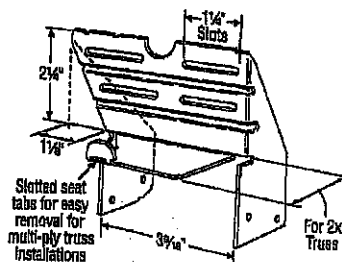


TC24

U.S. Patent 4,932,173

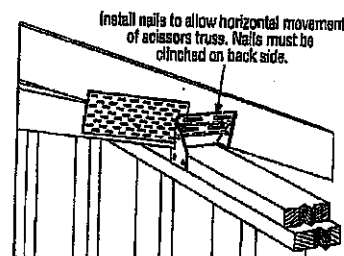


Typical TC24 Installation

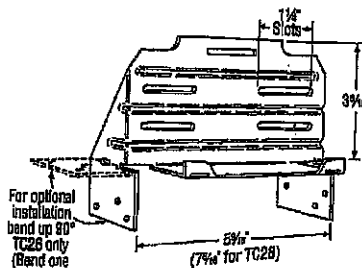


TC26

(TC28 Similar)

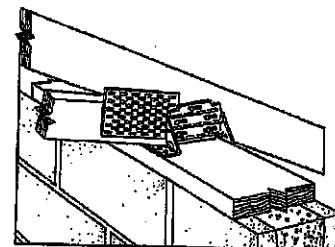

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer
(8", 10", 12" Wall Installation Similar)

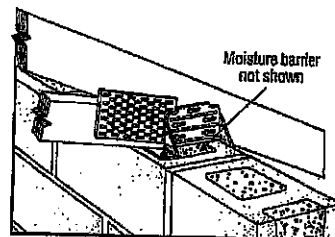


Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D-Fir-L	S-P-F
			Uplift (K _o =1.15)	Uplift (K _o =1.15)
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(5) 10d	1015	720
TC28	(5) 10d	(5) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D-Fir-L	S-P-F
			Uplift (K _o =1.15)	Uplift (K _o =1.15)
TC26	(5) 10d	(5) 10d x 1 1/2"	810	660
	(5) 10d	(5) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.
4. TC28 fastened to grouted concrete block with (5) - 3/4" x 2 1/4" Titen screws has a factored uplift resistance of 275 lb.

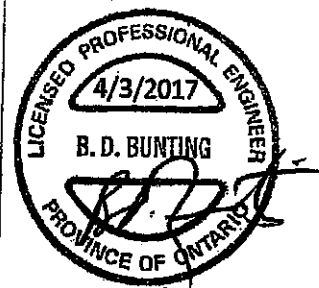

SIMPSON
STRONG-TIE

For more information, visit www.strongtie.com or call 1-800-999-5099. This document is a technical specification and should be used in conjunction with the Strong-Tie Truss Connector Catalog. © 2017 Simpson Strong-Tie Company.

(800) 999-5099
strongtie.com

H/TSP

SIMPSON
Strong-Tie

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_p = 1.15$)					
		To Rafters/ Truss	To Plates	To Studs	D.Fir-L			S-P-F		
					Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(5) 8d x 1½"	(4) 8d	—	740	685	300	680	485	215
					3.29	3.05	1.33	3.02	2.16	0.96
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
					3.58	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	285	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ³	18	(5) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A ³	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	565	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^{7,8}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1465	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	1 (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
		2 (12) 8d x 1½"	(15) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
TSP	16	(9) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
					5.76	1.98	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.98	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H6 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 8/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.162" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_p factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

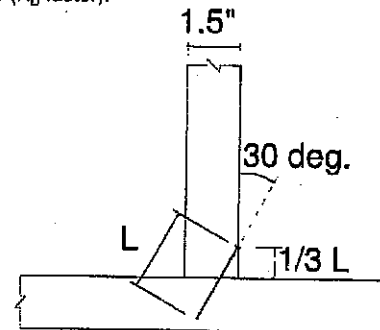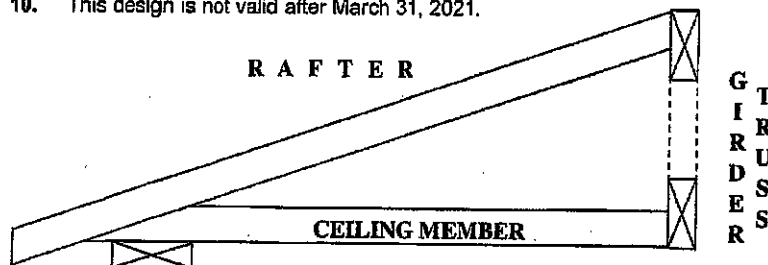


TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to wind or earthquake load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

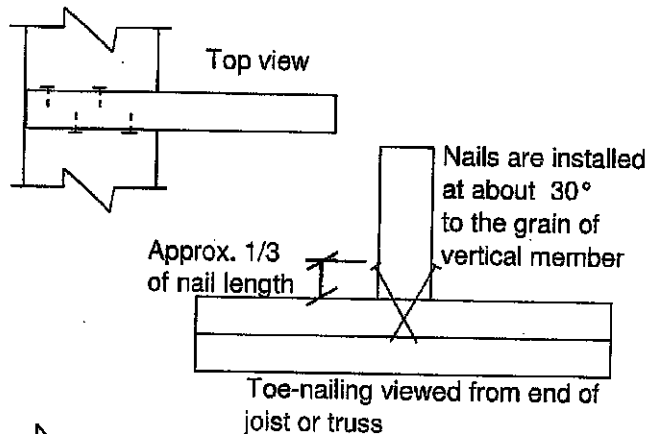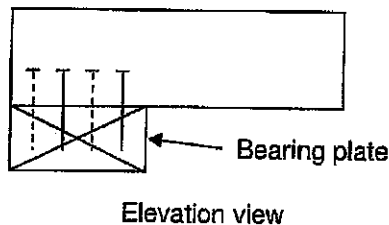

Toe-nailing on 2x4 Bearing Plate

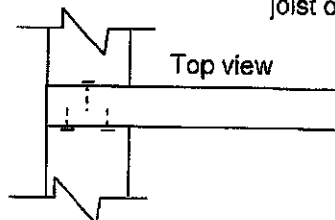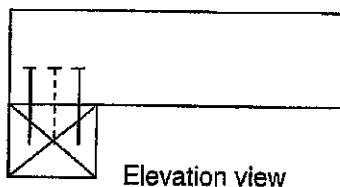

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7


PEO
Certificate No. 10889485




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/2" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

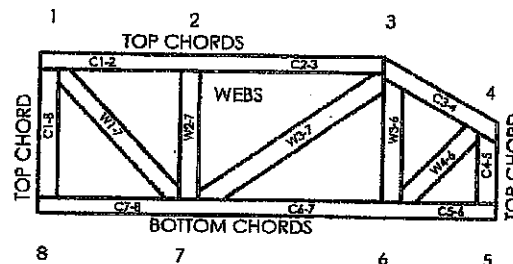

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MII-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

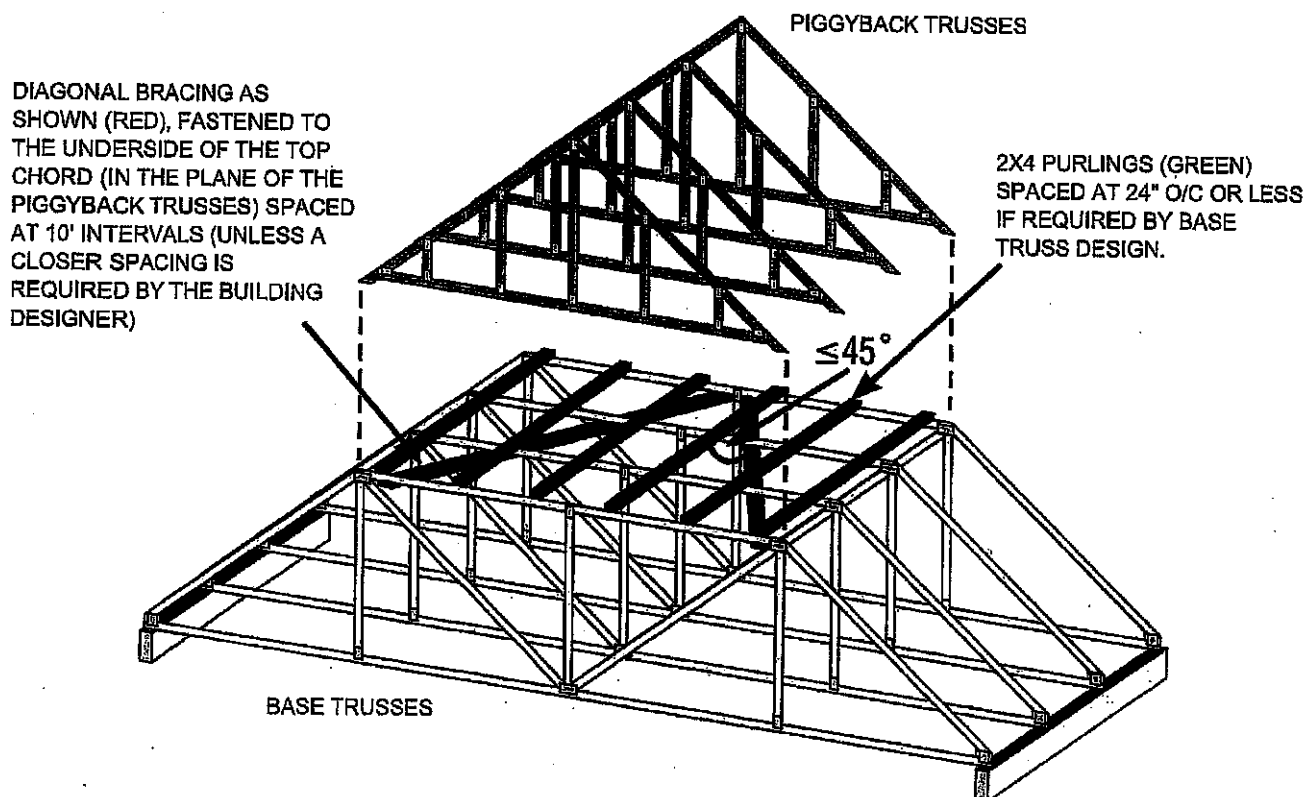


NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1800215

Feb 09, 2018