


44-08-00

1-00-00 6-04-00

ROOF PITCH 8/12 UNLESS NOTED

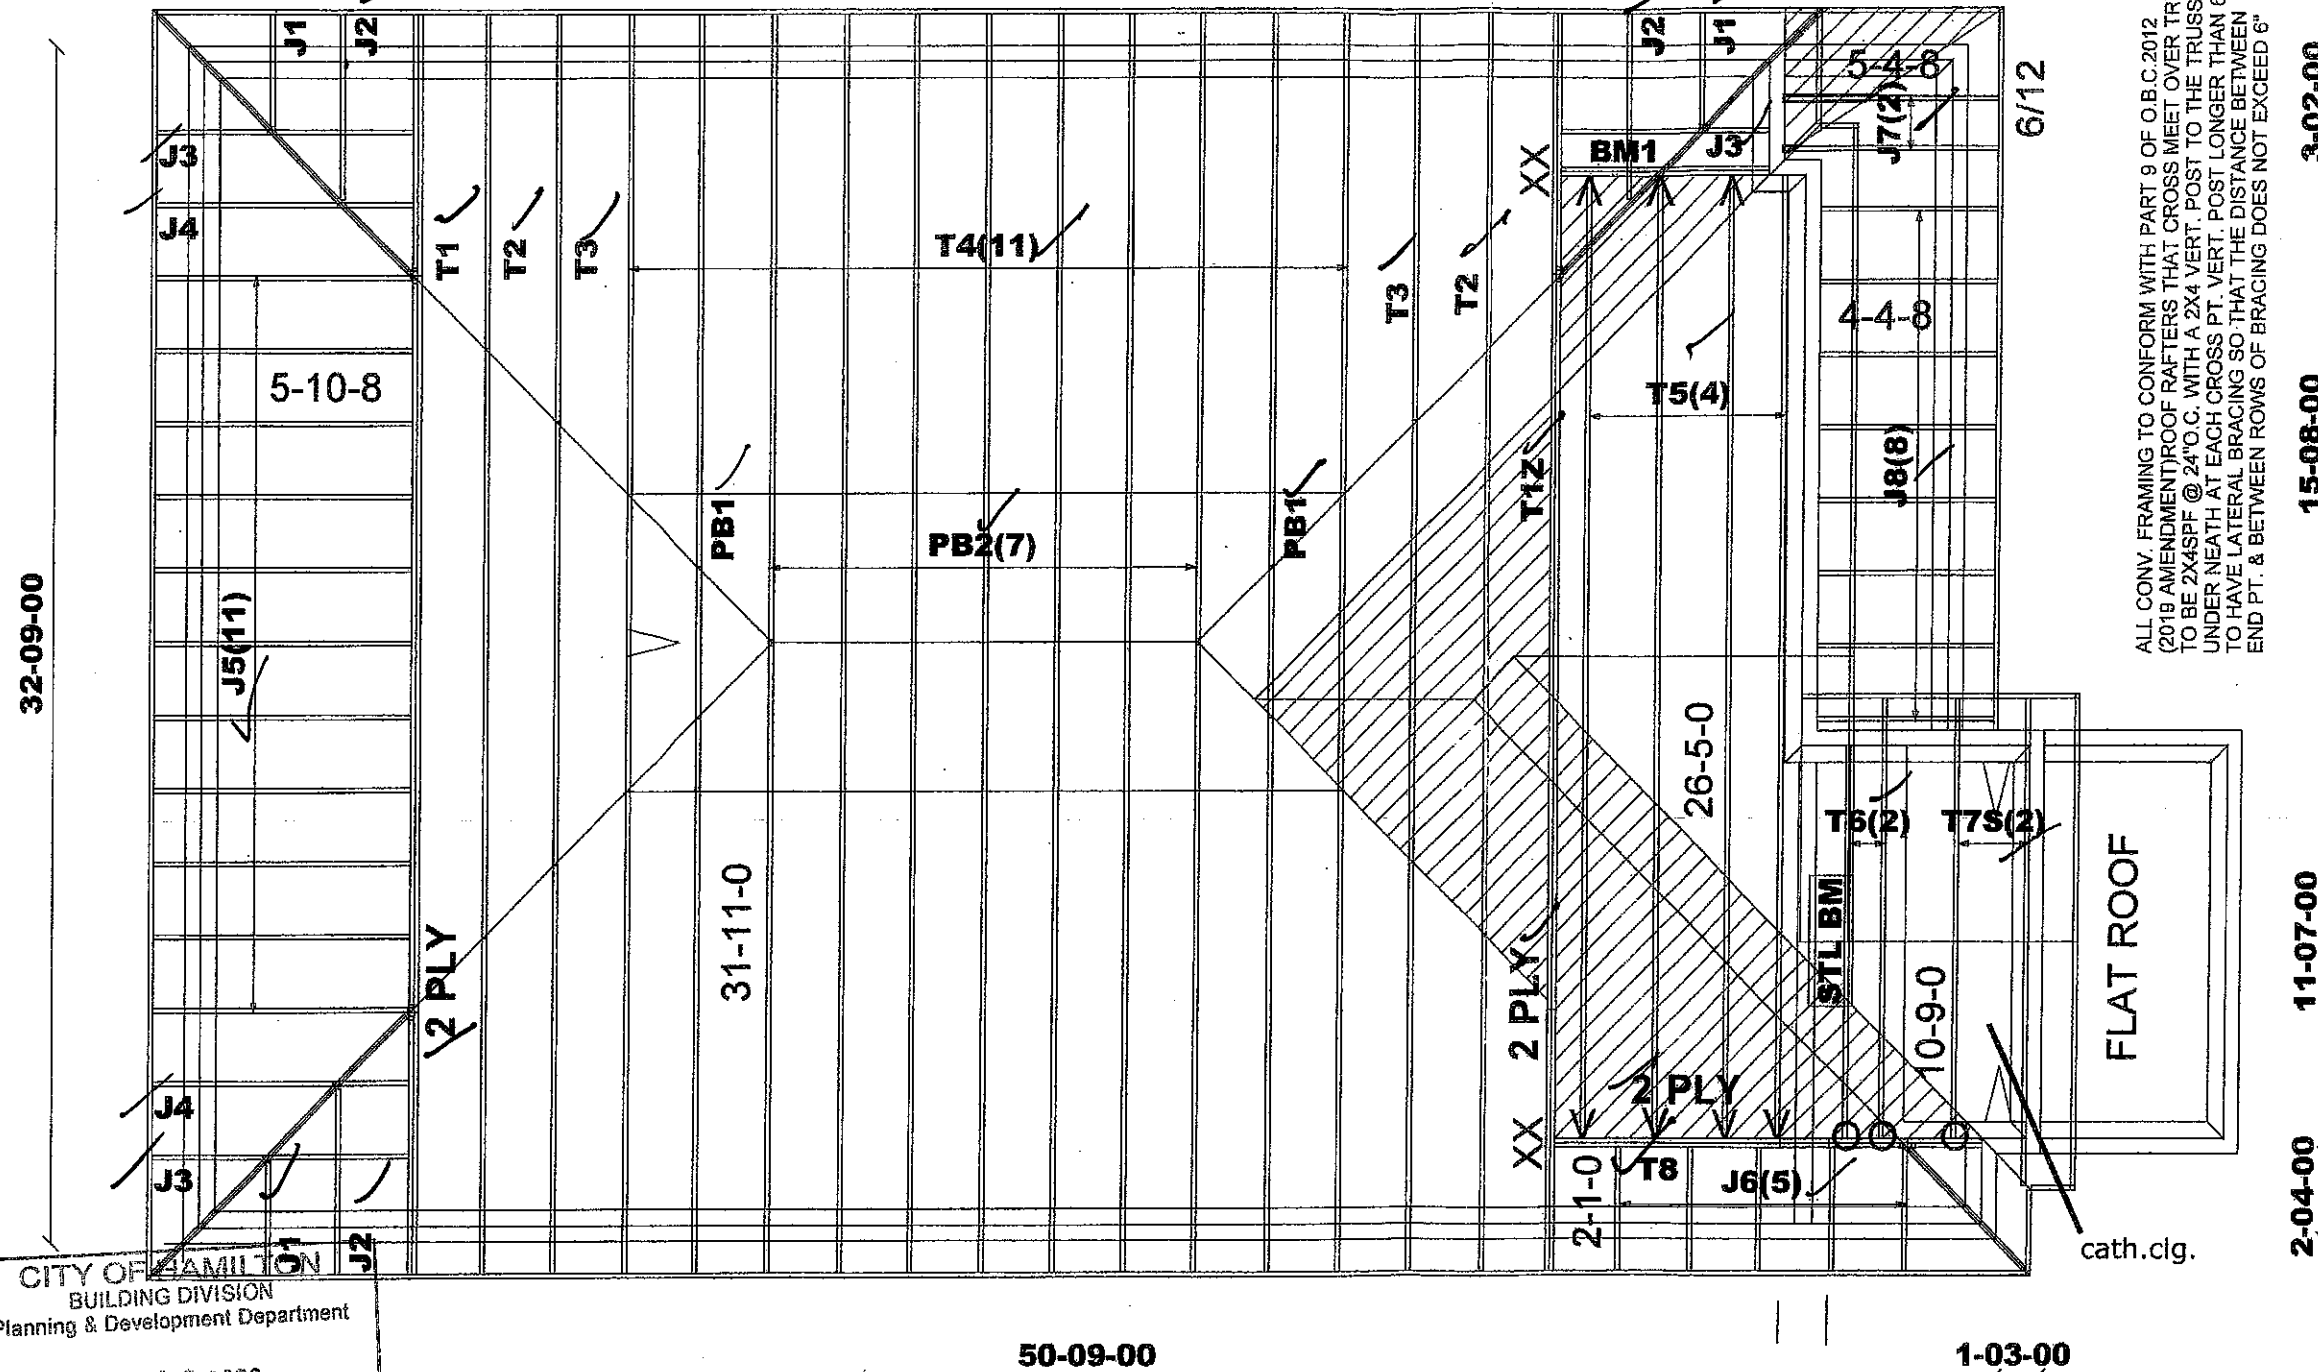

ASPHALT SHINGLES
12" FINISHED OH.
R.T.M.C.
2X6 EXTERIOR WALLS
2X6 FASCIA BOARD

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)

DENOTES
CONV.
FRAMING



DESIGN CONFORMS
WITH O.B.C.2012 PART 9
(2019 AMENDMENT)
DESIGN LOADS:
SNOW LOAD 25.6 PSF
TC DEAD 6 PSF
BC LIVE 0 PSF
BC DEAD 7.4 PSF

BM1 = 2-2X10 OF HAMILTON
Building Division

Permit No. 187682

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by

FOR CHIEF BUILDING OFFICIAL DATE Nov 6/2020

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department

OCT 06 2020

REC BY _____ DATE _____
REF'D TO _____ DATE _____

M13110



Job Track: 51225
Plan Log: 202404
Layout ID: 408163

Builder / Location: GREEN PARK HOMES / WATERDOWN
Project: RUSSELL GARDENS PH.3
Date: 2020-04-15 Sales: Mario DiCano Designer: AC7 IG

Model / Elevation: VALLEYCREEK 4/1


THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

ROOF PITCH 6/12 UNLESS NOTED

44-08-00

1-00-00 6-04-00

32-09-00

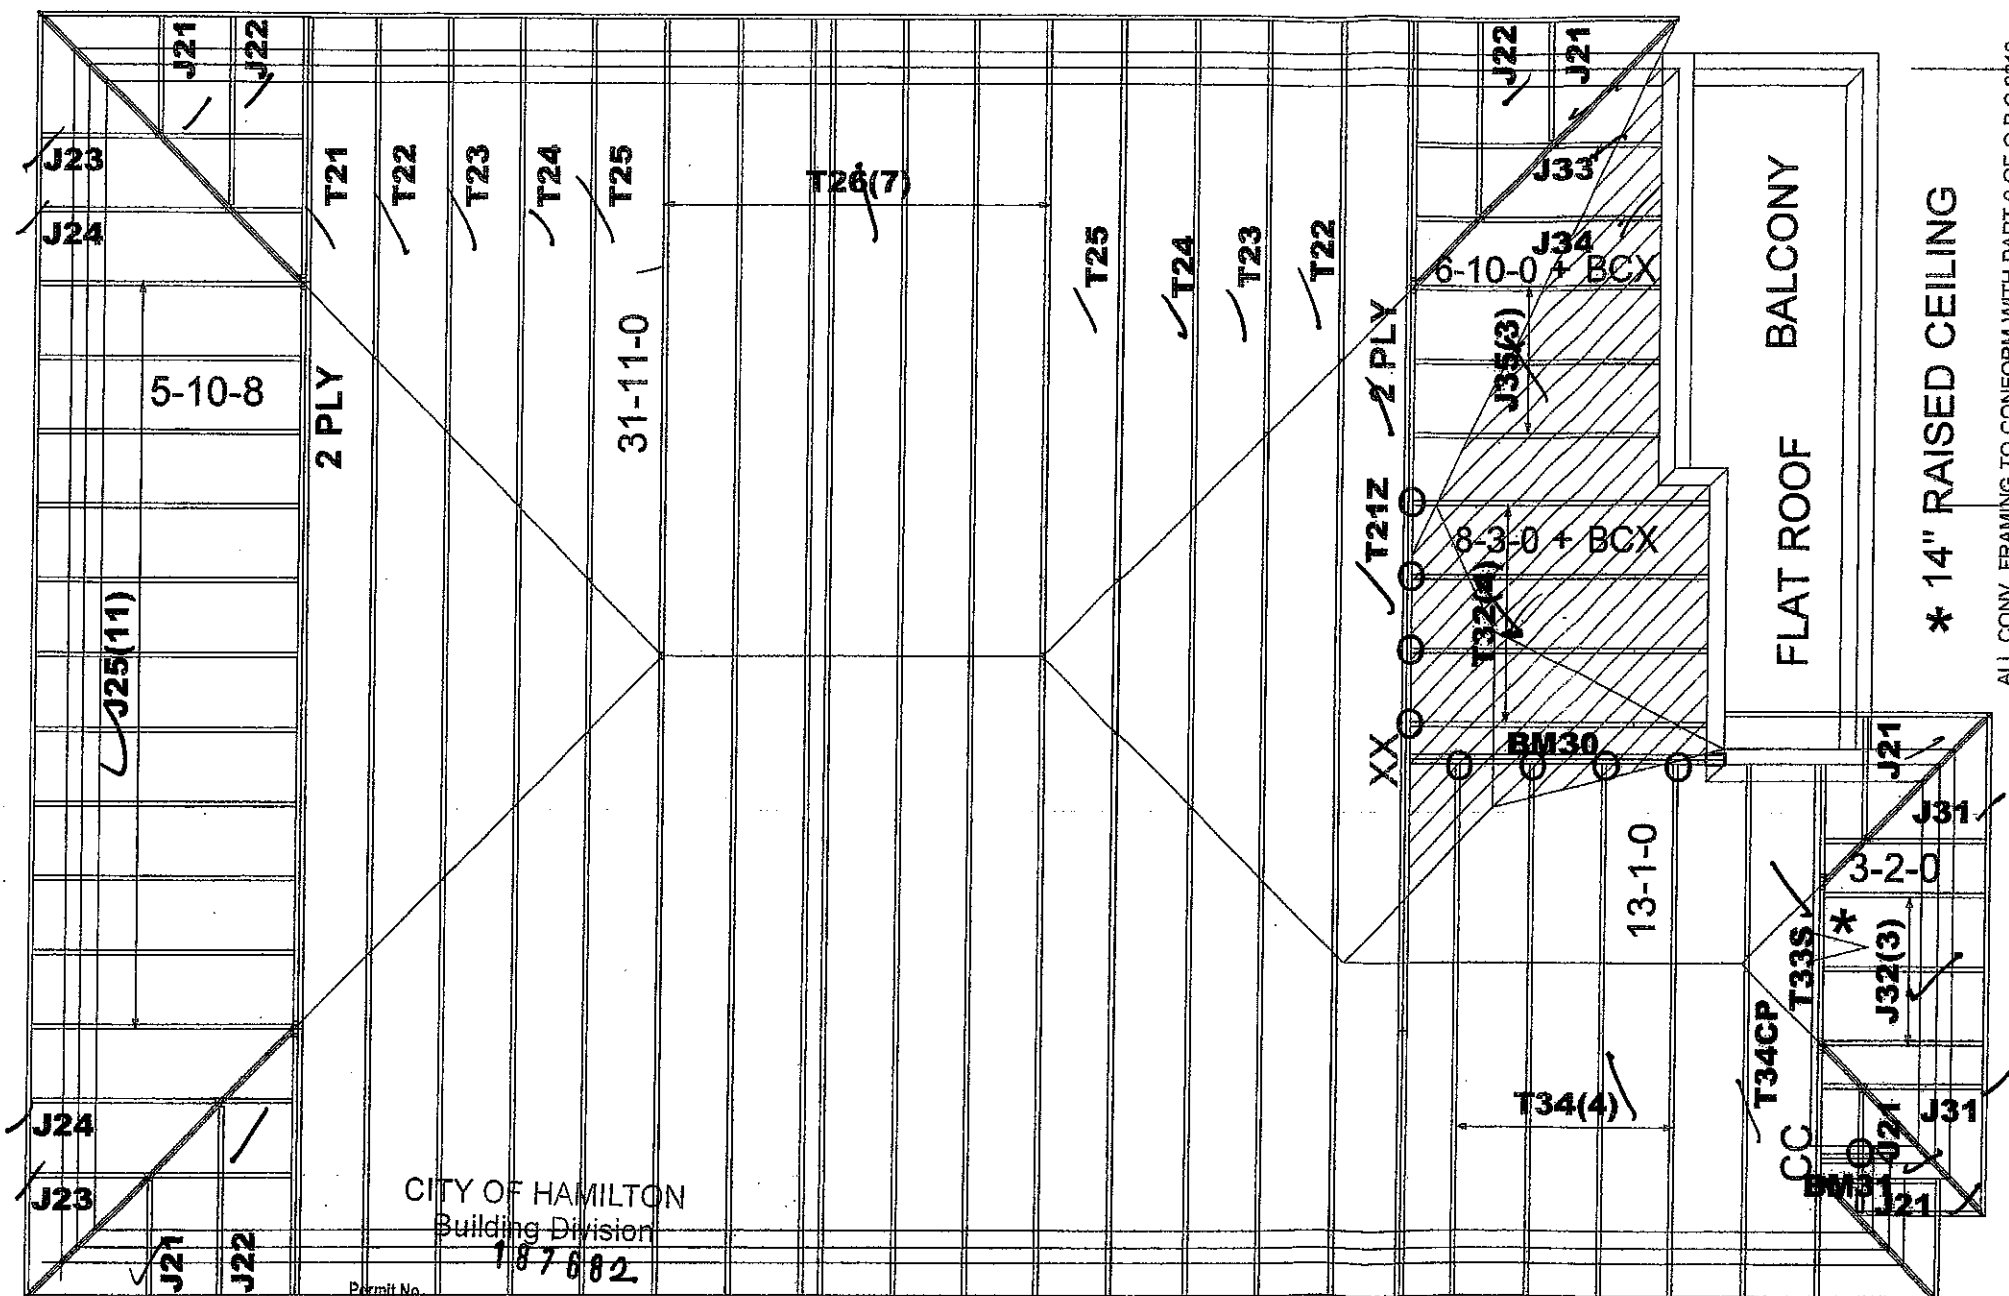


* 14" RAISED CEILING

ALL CONV. FRAMING TO CONFORM WITH PART 9 OF O.B.C.2012 (2019 AMENDMENT) ROOF RAFTERS THAT CROSS MEET OVER TRUSSES TO BE 2X4SPF @ 24"O.C. WITH A 2X4 VERT. POST TO THE TRUSS UNDER NEATH AT EACH CROSS PT. VERT. POST LONGER THAN 6" TO HAVE LATERAL BRACING SO THAT THE DISTANCE BETWEEN END PT. & BETWEEN ROWS OF BRACING DOES NOT EXCEED 6"

ASPHALT SHINGLES
12" FINISHED OH.
R.T.M.C.
2X6 EXTERIOR WALLS
2X6 FASCIA BOARD

HARDWARE:
LUS24 - (O)
HUSC26-2 - (CC)
HGUS26-2 - (XX)

DENOTES
CONV.
FRAMING



DESIGN CONFORMS
WITH O.B.C.2012 PART 9
(2019 AMENDMENT)
DESIGN LOADS:
SNOW LOAD 25.6 PSF
TC DEAD 6 PSF
BC LIVE 0 PSF
BC DEAD 7.4 PSF

BM30, BM31 = 2-2X10

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

DATE Nov 6/2020



Job Track: 51225
Plan Log: 202404
Layout ID: 408165

Builder / Location: GREEN PARK HOMES / WATERDOWN
Project: RUSSELL GARDENS PH.3
Date: 2020-04-15 Sales: Mario DiCano Designer: AC/JS

Model / Elevation: VALLEYCREEK 4/3


THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department
OCT 06 2020
REC BY _____ DATE _____
REP'D TO _____ DATE _____

Mitek ver 9.3.1.215


 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	DELIVERY SHIPLIST				Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: VALLEYCREEK 4 Lot #: Elevation: 1		Job Track: 51225 PlanLog: 202404 Layout ID: 408163 Ref # Page: 1 of 2 Date: 04-20-2020 Designer: Andrew Conway Sales Rep: Mario DiCano	
--	-------------------	--	--	--	---	--	---	--

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	8 /12	31-11-00	5-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	325.05 201.00		
	1 2-ply	T1Z Hip Girder	8 /12	31-11-00	5-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	325.05 201.00		
	2	T2 Hip	8 /12	31-11-00	6-07-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	283.27 180.00		
	2	T3 Hip	8 /12	31-11-00	7-11-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	283.41 178.00		
	11	T4 Hip	8 /12	31-11-00	9-03-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	1657.97 1032.17		
	4	T5 Common	8 /12	26-05-00	10-02-08	2 x 4		1-04-13 1-04-13	483.61 304.00		
	2	T6 Common	8 /12	10-09-00	4-11-13	2 x 4		1-04-13 1-04-13	82.8 53.00		
	2	T7S Scissor	8 /12 5 /12	10-09-00	4-11-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	89.85 80.33		
	1 2-ply	T8 Half Hip Girder	8 /12	11-11-08	2-09-08	2 x 4 2 x 6		1-04-13 2-09-08	124.58 84.33		
	2	PB1 Piggyback	8 /12	8-02-00	1-04-00	2 x 4			43.92 30.00		
	7	PB2 Piggyback	8 /12	8-02-00	2-08-11	2 x 4			142.79 86.33		
	3	J1 Jack-Open	8 /12	1-09-07	2-07-02	2 x 4	1-03-08 1-01	1-04-13 2-07-02	26.71 17.00		
	3	J2 Jack-Open	8 /12	1-10-08	3-11-02	2 x 4	1-03-08 1-10-15	1-04-13 2-07-13	35.12 23.00		
	3	J3 Jack-Open	8 /12	1-09-07	2-07-02	2 x 4	1-03-08 4-01-01	1-04-13 2-07-02	40.4 25.00		

DELIVERY SHIPLIST		
 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: VALLEYCREEK 4 Lot #: Elevation: 1	Job Track: 51225 PlanLog: 202404 Layout ID: 408163 Ref # Page: 2 of 2 Date: 04-20-2020 Designer: Andrew Conway Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	J4 Jack-Open	8 /12	3-09-07	3-11-02	2 x 4	1-03-08 2-01-01	1-04-13 3-11-02	32.6 20.67		
	11	J5 Jack-Open	8 /12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	215.33 133.83		
	5	J6 Jack-Open	8 /12	2-01-00	2-09-08	2 x 4	1-03-08	1-04-13 2-09-08	48.82 35.00		
	2	J7 Jack-Open	6 /12	5-04-08	3-07-15	2 x 4	1-03-08	4-03 2-07-11	30.92 20.00		
	8	J8 Jack-Open	6 /12	4-04-08	3-01-15	2 x 4	1-03-08	4-03 2-01-11	99.04 64.00		

TOTAL # TRUSS= 75 TOTAL BFT OF ALL TRUSSES= 2748.66 BFT. TOTAL WEIGHT OF ALL TRSSES 4371.22 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
7	Hardware	LJS26DS	
3	Hardware	LUS24	
2	Hardware	HGUS26-2	

TOTAL NUMBER OF
ITEMS= 12



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: VALLEYCREEK 4
 Lot #:
 Elevation: 3



Job Track: 51225
 PlanLog: 202404
 Layout ID: 408165
 Ref #
 Page: 1 of 2
 Date: 04-15-2020
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T21 Hip Girder	6/12	31-11-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	310.75 194.00		
	1 2-ply	T21Z Hip Girder	6/12	31-11-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	310.75 194.00		
	2	T22 Hip	6/12	31-11-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	259.03 161.67		
	2	T23 Hip	6/12	31-11-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	258.25 161.33		
	2	T24 Hip	6/12	31-11-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	271.21 168.33		
	2	T25 Hip	6/12	31-11-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	262.57 165.00		
	7	T26 Hip	6/12	31-11-00	9-01-12	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	904.65 565.83		
	4	T32 Roof Special	6/12	8-03-00	4-01-04	2 x 4		1-00-00 4-01-04	119.18 76.00		
	1	T33S Hip Girder	6/12	13-01-00	3-11-00	2 x 4	1-03-08	1-02-00 1-02-00	54.31 36.00		
	4	T34 Common	6/12	13-01-00	5-00-04	2 x 4	1-03-08	1-02-00 2-04-00	208.67 135.33		
	1	T34CP Hip	6/12	13-01-00	4-11-00	2 x 4	1-03-08	1-02-00 2-04-00	51.56 33.83		
	6	J21 Jack-Open	6/12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	42.13 28.00		
	3	J22 Jack-Open	6/12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	28.71 18.00		
	2	J23 Jack-Open	6/12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	23.16 14.67		

 TAMARACK ROOF TRUSSES INC. ALFA LUMBER GROUP		DELIVERY SHIPLIST			
		Lumber Yard: TAMARACK LUMBER		Job Track: 51225	
Builder: GREEN PARK HOMES		Plan Log: 202404			
Project: RUSSELL GARDENS PH.3		Layout ID: 408165			
Location: WATERDOWN		Ref #			
Model: VALLEYCREEK 4		Page: 2 of 2			
Lot #:		Date: 04-15-2020			
Elevation: 3		Designer: Andrew Conway			
		Sales Rep: Mario DiCano			

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	J24 Jack-Open	6 /12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	28.26 17.33		
	11	J25 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	184.74 117.33		
	2	J31 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 1-03-01	1-02-00 2-01-08	17.31 12.00		
	3	J32 Jack-Open	6 /12	3-02-00	2-09-00	2 x 4	1-03-08	1-02-00 2-09-00	30.76 22.00		
	1	J33 Jack-Open	6 /12	6-10-00	2-01-08	2 x 4		8-04 4-01-04	13.22 8.67		
	1	J34 Jack-Open	6 /12	6-10-00	3-01-08	2 x 4		8-04 4-01-04	15.77 10.00		
	3	J35 Jack-Open	6 /12	6-10-00	4-01-04	2 x 4		8-04 4-01-04	67.97 45.00		

TOTAL # TRUSS= 63

TOTAL BFT OF ALL TRUSSES= 2184.32 BFT.

TOTAL WEIGHT OF ALL TRSSES 3460.95 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
9	Hardware	LUS24	
1	Hardware	HGUS26-2	
1	Hardware	HUSC26-2	

TOTAL NUMBER OF
ITEMS= 11

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:48:35 2020 Page 1


ID:KIHNL?kIAuBVUyBrpQW7E8zls6y-tmv3EggedikXqcuTINYXLUUdWdL2jdlw_1K2addzPX

1-3-8 0-0 3-0-8 2-10-0 5-10-8 5-1-2 10-11-10 4-11-14 15-11-8 4-11-14 20-11-8 5-1-2 25-0-8 2-10-0 28-10-8 3-0-8 31-11-0 33-2-8 1-3-8

Scale = 1/2" = 1'-0"



Structural Component only 1/2



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408163	T1	1	2	TRUSS DESC.		

Tamarack Pool Truss, Burlington

Version 8.310 S Oct 29 2018 Mitek Industries, Inc. Fri Apr 17 08:46:35 2020 Page 2
ID:KIHNL7klAuBVUqBrmQW7E8zls6y-lmv3EgegdikXgcUTINYXUUGDwL2ldw 1K2addzPX0

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
V	BMV+w	MT20	3.0	6.0		
Y	BMV1+p	MT20	3.0	6.0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LOC	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
D	5-10-8	-584	-584	---	FRONT	VERT	TOTAL	---	C1
F	15-11-8	-178	-178	---	FRONT	VERT	TOTAL	---	C1
G	17-11-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
I	26-9-8	-584	-584	---	FRONT	VERT	TOTAL	---	C1
N	29-11-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
P	25-11-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
R	19-11-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
S	15-11-8	-36	-36	---	FRONT	VERT	TOTAL	---	C1
T	11-11-4	-36	-36	---	FRONT	VERT	TOTAL	---	C1
V	5-11-4	-36	-36	---	FRONT	VERT	TOTAL	---	C1
X	1-11-4	-36	-36	---	FRONT	VERT	TOTAL	---	C1
Z	7-11-4	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AA	9-11-4	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AB	11-11-4	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AC	13-11-4	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AD	19-11-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AE	21-11-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AF	23-11-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AG	3-11-4	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AH	7-11-4	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AI	9-11-4	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AJ	13-11-4	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AK	17-11-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AL	21-11-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AM	23-11-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AN	27-11-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

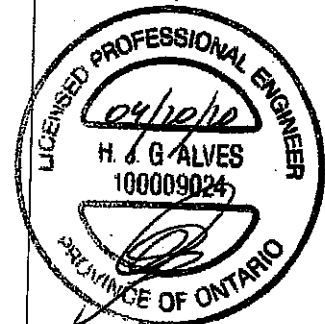

Structural component only
DWG# T-2008468

72


JOB NAME 408163	TRUSS NAME T1Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Road Truss, Burlington

Version 8.310 S Oct 29 2019 MTK Industries, Inc. Fri Apr 17 08:46:38 2020 Page 1

ID: KIHNL2kIAuBVUgBrpCW7E8zIs9y-LzTSS0eiQesOlmTis43m0hpSgkKgM5c8G_0893zPXH

Scale = 1:52.6

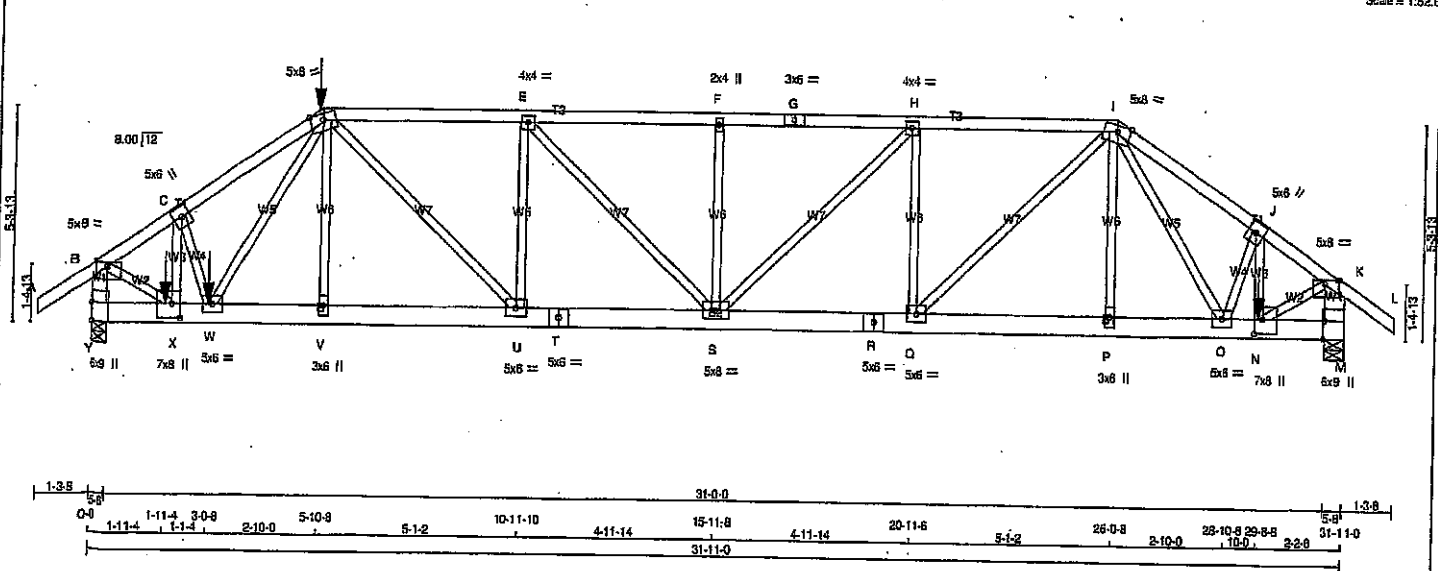

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
G - I	2x4	DRY	No.2	SPF	
I - L	2x4	DRY	No.2	SPF	
Y - B	2x6	DRY	No.2	SPF	
M - K	2x6	DRY	No.2	SPF	
Y - T	2x6	DRY	No.2	SPF	
T - R	2x6	DRY	No.2	SPF	
R - M	2x6	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY, SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122'x3') SPIRAL NAILS		
A-D	12	SIDE(61.0)
D-G	12	SIDE(61.0)
G-I	12	TOP
I-L	12	TOP
Y-B	12	TOP
M-K	12	TOP
BOTTOM CHORDS : (0.122'x3') SPIRAL NAILS		
Y-T	12	SIDE(915.8)
T-R	12	TOP
R-M	12	SIDE(915.8)
WEBS : (0.122'x3') SPIRAL NAILS		
2x3	6	SIDE(391.7)
C-X	2	
J-N	2	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	1.25	4.00	
C TMVW-w	MT20	5.0	8.0			
D TTWWW-m	MT20	5.0	8.0	Edge		
E TMVW-t	MT20	4.0	4.0			
F TMVW-w	MT20	2.0	4.0			
G TS-t	MT20	3.0	5.0			
H TMVW-t	MT20	4.0	4.0			
I TTWWW-m	MT20	5.0	8.0	Edge		
J TMVW-w	MT20	5.0	8.0			
K TMVW-p	MT20	5.0	8.0	1.25	4.00	
M BMV1-t	MT20	6.0	9.0	Edge	0.50	
N BMVW-t	MT20	7.0	8.0	4.25	2.50	
O, Q, U, W						
O BMVW-t	MT20	5.0	8.0			
P BMVW-w	MT20	3.0	8.0			
R BS-t	MT20	5.0	8.0			
S BMVW-w	MT20	5.0	8.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	4859	4859	0	5-8
Y VERT	8873	8873	0	5-8
M VERT	0	0	0	5-8

UNFACTORED REACTIONS	1ST LOASE	MAX/MIN. COMPONENT REACTIONS
JT COMBINED	3433	2308 / 0
Y COMBINED	4850	3240 / 0
M COMBINED	0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Y, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.67 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED MEMB. FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO		
A-B	0 / 35	-91.8	-91.8 0.07 (1)	X-C	-1315 / 0	0.12 (1)
B-C	-4946 / 0	-91.8	-91.8 0.11 (1)	Y-D	0 / 363	0.04 (1)
C-D	-5328 / 0	-91.8	-91.8 0.22 (1)	D-U	0 / 1211	0.15 (1)
D-E	-4737 / 0	-91.8	-91.8 0.30 (1)	U-E	-798 / 0	0.18 (1)
E-F	-5022 / 0	-91.8	-91.8 0.31 (1)	E-S	0 / 401	0.05 (1)
F-G	-5022 / 0	-91.8	-91.8 0.31 (1)	S-F	-420 / 0	0.09 (1)
G-H	-5022 / 0	-91.8	-91.8 0.30 (1)	H-Q	0 / 332	0.04 (1)
H-I	-4787 / 0	-91.8	-91.8 0.18 (1)	Q-H	-747 / 0	0.15 (1)
I-J	-8115 / 0	-91.8	-91.8 0.27 (1)	J-I	0 / 1148	0.14 (1)
J-K	-6704 / 0	-91.8	-91.8 0.18 (1)	K-I	0 / 233	0.03 (1)
K-L	0 / 36	-91.8	-91.8 0.07 (1)	N-J	0 / 1389	0.17 (1)
Y-B	-4819 / 0	0.0	0.0 0.17 (1)	B-X	0 / 4525	-0.56 (1)
M-K	-5463 / 0	0.0	0.0 0.23 (1)	X-N	0 / 6121	0.78 (1)
Y-X	0 / 0	-18.5	-18.5 0.02 (1)	C-W	0 / 854	0.11 (1)
X-W	0 / 4124	-18.5	-18.5 0.46 (1)	W-D	0 / 1148	0.14 (1)
W-V	0 / 3860	-18.5	-18.5 0.45 (1)	O-J	-1448 / 0	0.14 (1)
V-U	0 / 3887	-18.5	-18.5 0.32 (1)	I-O	0 / 2298	0.28 (1)
U-T	0 / 4738	-18.5	-18.5 0.34 (1)			
T-S	0 / 4738	-18.5	-18.5 0.34 (1)			
S-R	0 / 4787	-18.5	-18.5 0.35 (1)			
R-Q	0 / 4787	-18.5	-18.5 0.35 (1)			
Q-P	0 / 3961	-18.5	-18.5 0.31 (1)			
P-O	0 / 3956	-18.5	-18.5 0.33 (1)			
O-N	0 / 5579	-18.5	-18.5 0.68 (1)			
N-M	0 / 0	-18.5	-18.5 0.32 (1)			

FACTORED CONCENTRATED LOADS (LBS)	JT LOC.	LC1	MAX-	FACE	DR.	TYPE	TOTAL
D	5-10-8	-399	-399	---	BACK	VERT	100009024
N	29-8-8	-5011	-5011	---	BACK	VERT	
W	3-0-8	-2525	-2525	---	BACK	VERT	
X	1-11-4	-36	-36	---	BACK	VERT	

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2018, OBC 2012, ABC 2019

- PART 9 OF OBC 2012 (2019 AMENDMENT)

- CSA 086-09, CSA 086-14

- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06')

CALCULATED VERT. DEFL.(LL) = L/999 (0.11')

ALLOWABLE DEFL.(TL) = L/360 (1.06')

CALCULATED VERT. DEFL.(TL) = L/999 (0.20')

CS: TC=0.31/1.00 (E-F-1), BC=0.68/1.00 (N-O-1), WB=0.78/1.00 (K-N-1), SS=0.25/1.00 (N-O-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 818 354 1667 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

GRIP=0.87 (B) (INPUT = 0.90)

METAL=0.72 (X) (INPUT = 1.00)

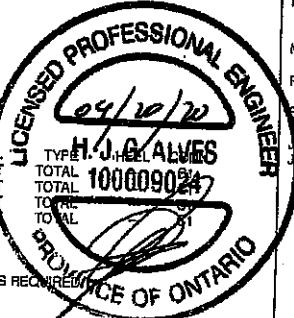

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408163	T1Z	1	2	GREEN PARK HOMES	


Tamarack Pool Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:46:36 2020 Page 2
ID:KIHL7kiAuBVUqBmQW7E8zls6v-LzTSS0elOcsOImTIs43m0haSqkKqM5c8G o883zP1XH

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
T	BS-H	MT20	5.0	8.0		
V	BMW+W	MT20	3.0	6.0		
X	BMW+W-H	MT20	7.0	8.0	4.25	2.50
Y	BMV1-H	MT20	6.0	9.0	5.50	


Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

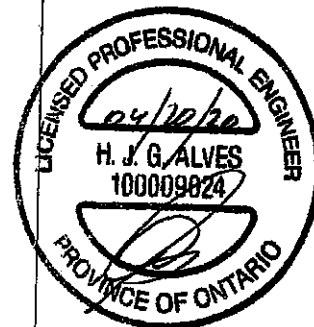

Structural component only
DWG# T-2006469

7/2

JOB NAME 408163	TRUSS NAME T2	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:46:37 2020 Page 1 ID:KIHNL7k/AuBVUgBrpQW7EBzlsy-p80qflJw9v_Fvw2sPnb7ZvMav8k55XdlUeXhVzPDXG 1-3-8 04 4-0-8 4-0-8 3-10-0 7-10-8 5-5-1 13-3-8 5-3-13 18-7-7 24-0-8 3-10-0 27-10-8 4-0-8 31-11-0 33-2-8 Scale = 1:52.6					

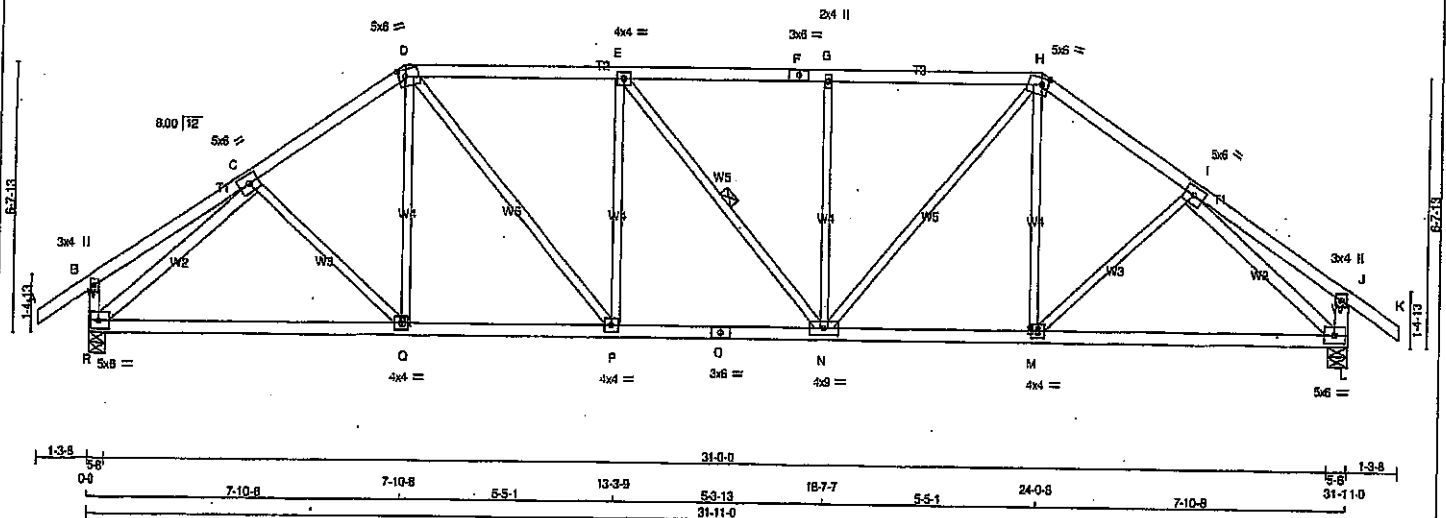

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2
J - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2

ALL WEBS EXCEPT	SIZE	DRY	LUMBER
R - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0		
C	TMWV-t	MT20	5.0	6.0		
D	TTWW-m	MT20	5.0	6.0	2.00	2.00
E	TMWV-t	MT20	4.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMW-w	MT20	2.0	4.0		
H	TTWW-m	MT20	5.0	6.0	2.00	2.00
I	TMWV-t	MT20	5.0	6.0		
J	TMV-p	MT20	3.0	4.0		
L	BMVW-t	MT20	5.0	6.0		
M, P, Q						
M	BMWV-t	MT20	4.0	4.0		
N	BMWVW-t	MT20	4.0	6.0		
O	BS-t	MT20	3.0	6.0		
R	BMVW-t	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	DOWN	UP	IN-SX
R	1885	0	0	5-8
L	1885	0	0	5-8

UNFACTORED REACTIONS

1ST LOASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED
R	1331 887 / 0
L	1331 887 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.12 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO		
A-B	0 / 35	-91.8	10.00	C-Q	0 / 57	10.00
B-C	0 / 22	-91.8	10.00	Q-D	0 / 145	10.00
C-D	-2020 / 0	-91.8	10.00	D-E	0 / 814	10.00
D-E	-2191 / 0	-91.8	10.00	E-F	-533 / 0	10.00
E-F	-2189 / 0	-91.8	10.00	F-G	-2 / 0	10.00
F-G	-2189 / 0	-91.8	10.00	G-H	-533 / 0	10.00
G-H	-2189 / 0	-91.8	10.00	H-I	0 / 811	10.00
H-I	-2020 / 0	-91.8	10.00	I-J	0 / 147	10.00
I-J	0 / 22	-91.8	10.00	J-K	0 / 57	10.00
J-K	0 / 35	-91.8	10.00	K-L	-2272 / 0	10.00
K-L	-266 / 0	0.0	10.00	L-M	-2273 / 0	10.00
L-M	-266 / 0	0.0	10.00			
M-L	0 / 1655	-18.5	10.00			
	0 / 1682	-18.5	10.00			
	0 / 2191	-18.5	10.00			
	0 / 2191	-18.5	10.00			
	0 / 1662	-18.5	10.00			
	0 / 1655	-18.5	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2018
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 085-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (1.08')
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.10')
ALLOWABLE DEFL. (TL) = $L/360$ (1.08')
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.19')

CSK: TO=0.47/1.00 (D-E:1), BO=0.41/1.00 (N-P:1), WB=0.77/1.00 (H-L:1), SS=0.23/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	(PL)
MT20	618	354	1687

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

J GRIP= 0.86 (D) (INPUT = 0.80)
J METAL= 0.73 (O) (INPUT = 1.03)

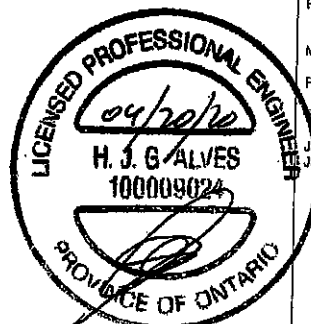


Structural component only
DWG# T-2006470

JOB NAME 408163	TRUSS NAME T3	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	-------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:48:39 2020 Page 1
ID: KIHNL7kAuBVUgBrpQW7E8zls6y-mY8a41hAhXE9ECEXCdTeKRw5yQbZQEayy0omOzPuXE

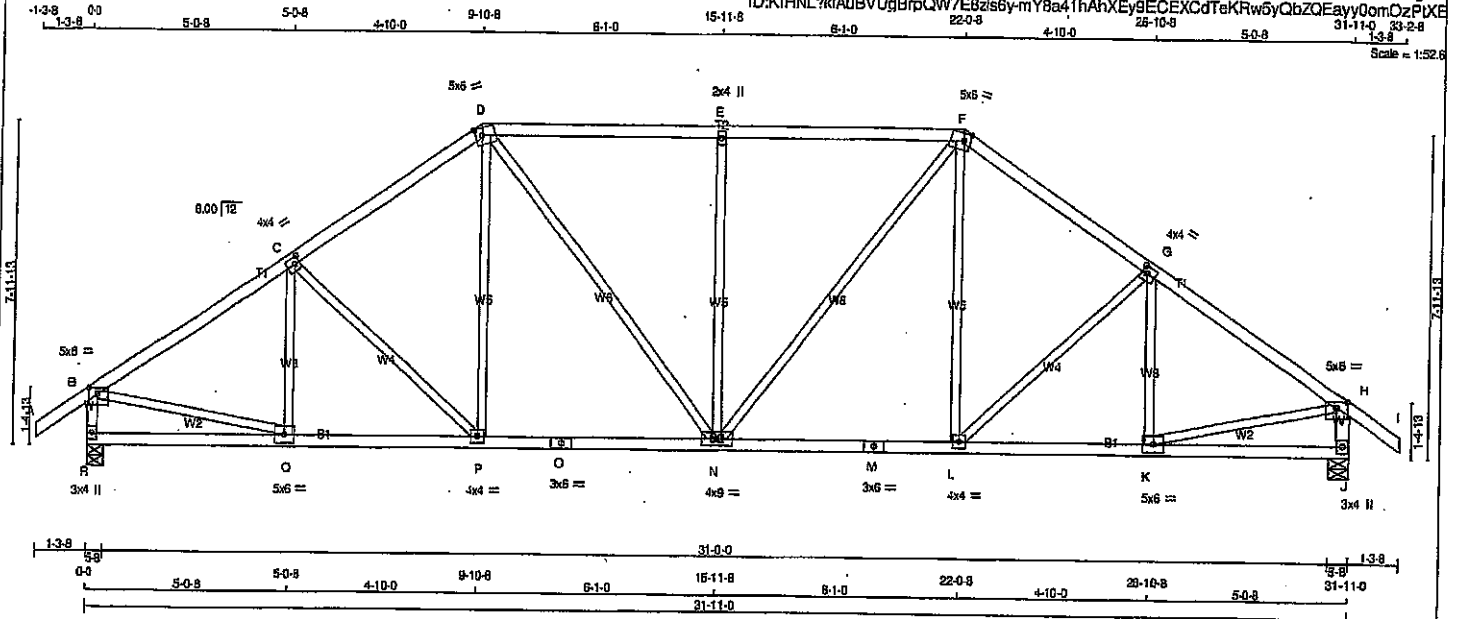

TOTAL WEIGHT = 2 X 142 = 283 lb
[M/F]

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No. 2	SPF	
D - F	2x4	DRY	No. 2	SPF	
F - I	2x4	DRY	No. 2	SPF	
I - B	2x4	DRY	No. 2	SPF	
B - H	2x4	DRY	No. 2	SPF	
H - C	2x4	DRY	No. 2	SPF	
C - M	2x4	DRY	No. 2	SPF	
M - J	2x4	DRY	No. 2	SPF	

ALL WEBS 2x3 DRY No. 2
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	5.0	8.0	1.75	3.00
C	TMWW-l	MT20	4.0	4.0	2.00	1.50
D	TTWW-m	MT20	5.0	6.0	2.25	2.00
E	TMWW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	8.0	2.25	2.00
G	TMWW-l	MT20	4.0	4.0	2.00	1.50
H	TMWW-p	MT20	5.0	8.0	1.75	3.00
J	BMV-l-p	MT20	3.0	4.0		
K	BMWW-l	MT20	5.0	6.0		
L	BMWW-l	MT20	4.0	4.0		
M	BS-l	MT20	3.0	6.0		
N	BMWW-l	MT20	4.0	9.0		
O	BS-l	MT20	3.0	6.0		
P	BMWW-l	MT20	4.0	4.0		
Q	BMWW-l	MT20	5.0	6.0		
R	BMV-l-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
R	1885	0	1885	0	5-8	5-8
J	1885	0	1885	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE		MAX/MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1331	887 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0
J	1331	887 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO. 2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.35 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	Q-C	-280 / 0	0.08 (1)
B-C	-2071 / 0	-91.8	-91.8 0.35 (1)	4.39	C-P	-244 / 0	0.20 (1)
C-D	-1915 / 0	-91.8	-91.8 0.34 (1)	4.55	P-D	0 / 267	0.08 (1)
D-E	-1885 / 0	-91.8	-91.8 0.49 (1)	4.35	D-N	0 / 508	0.11 (1)
E-F	-1885 / 0	-91.8	-91.8 0.49 (1)	4.35	N-E	-584 / 0	0.83 (1)
F-G	-1915 / 0	-91.8	-91.8 0.34 (1)	4.55	N-F	0 / 508	0.11 (1)
G-H	-2071 / 0	-91.8	-91.8 0.35 (1)	4.39	L-F	0 / 267	0.08 (1)
H-I	0 / 35	-91.8	-91.8 0.12 (1)	10.00	L-G	-244 / 0	0.20 (1)
R-B	-1844 / 0	0.0	0.0 0.19 (1)	6.16	K-G	-280 / 0	0.09 (1)
J-H	-1844 / 0	0.0	0.0 0.19 (1)	6.16	B-Q	0 / 1787	0.40 (1)
					K-H	0 / 1787	0.40 (1)
R-Q	0 / 0	-18.5	-18.5 0.10 (4)	10.00			
Q-P	0 / 1747	-18.5	-18.5 0.34 (1)	10.00			
P-O	0 / 1570	-18.5	-18.5 0.32 (1)	10.00			
O-N	0 / 1570	-18.5	-18.5 0.32 (1)	10.00			
N-M	0 / 1570	-18.5	-18.5 0.32 (1)	10.00			
M-L	0 / 1570	-18.5	-18.5 0.32 (1)	10.00			
L-K	0 / 1747	-18.5	-18.5 0.34 (1)	10.00			
K-J	0 / 0	-18.5	-18.5 0.10 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.06")
CALCULATED VERT. DEFL. (LL) = L/999 (0.08")
ALLOWABLE DEFL. (TL) = L/360 (1.06")
CALCULATED VERT. DEFL. (TL) = L/999 (0.18")

CSI: TC=0.49/1.00 (D-E:1), BC=0.34/1.00 (P-Q:1),
WB=0.83/1.00 (E-N:1), SSI=0.27/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN
MT20 518 354 1857 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.86 (Q) (INPUT = 0.90)
JSI METAL = 0.51 (O) (INPUT = 1.00)

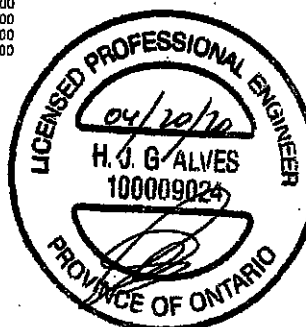

Structural component only
DWG# T-2006471

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408163	T4	11	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:46:40 2020 Page 1
ID:KHNL7kAuBVUgBrpQW7E8zlsGy-EklyHhQsRpmNnR5w8IBX_4IMmZlxAJAcmlqzPXKD
31-11-0 33-2-8
Scale = 1:54.5

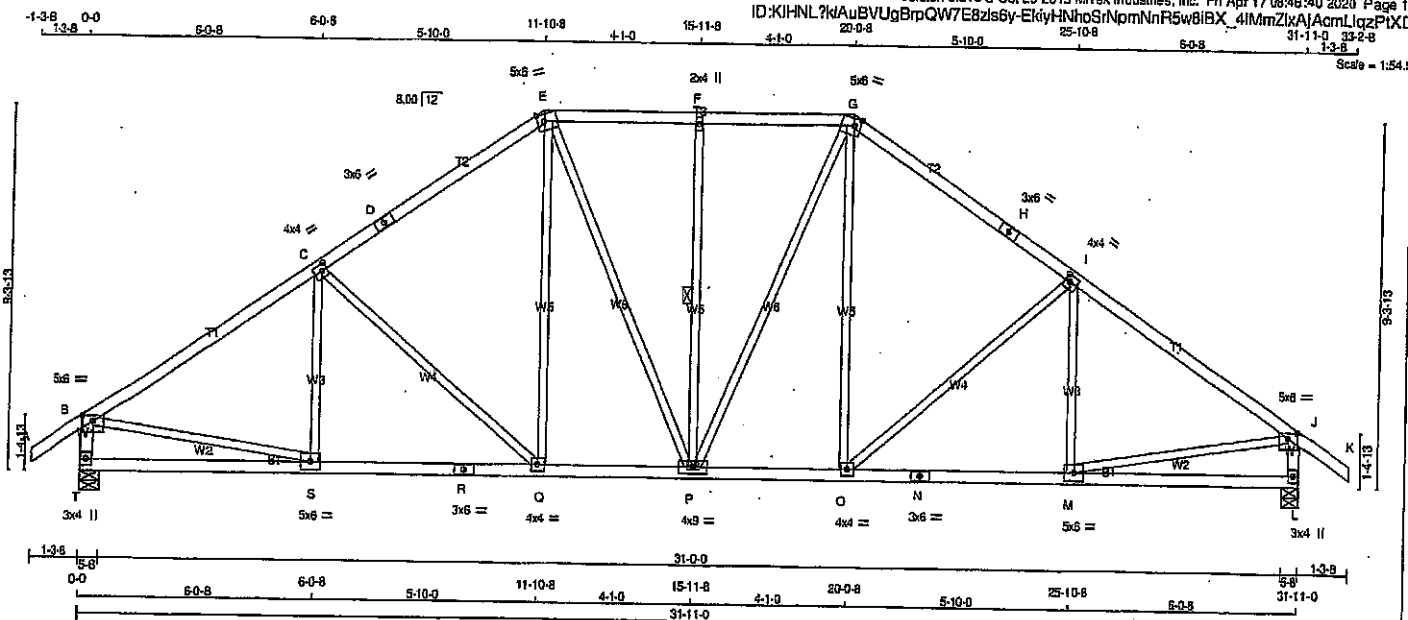

LUMBER

N.L.G.A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
B - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
T - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
T - R	2x4	DRY	No.2
R - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	3.00
C	TMVW-1	MT20	4.0	4.0	2.00	1.50
D	TS-1	MT20	3.0	6.0		
E	TTWW-m	MT20	5.0	6.0	2.25	2.00
F	TMVW-w	MT20	2.0	4.0		
G	TTWW-m	MT20	5.0	6.0	2.25	2.00
H	TS-1	MT20	3.0	6.0		
I	TMVW-1	MT20	4.0	4.0	2.00	1.50
J	TMVW-p	MT20	5.0	6.0	1.75	3.00
L	BMV1-p	MT20	3.0	4.0		
M	BMVW-1	MT20	5.0	6.0		
N	BS-1	MT20	3.0	6.0		
O	BMVW-1	MT20	4.0	4.0		
P	BMVW-1	MT20	4.0	4.0		
Q	BMVW-1	MT20	4.0	4.0		
R	BS-1	MT20	3.0	6.0		
S	BMVW-1	MT20	5.0	6.0		
T	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX	BRG
T	1885	0	1885	0	0	0	5-8	5-8	5-8
L	1885	0	1885	0	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
T	1331	887 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0	0 / 0
L	1331	887 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.16 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	S-C	-194 / 35	0.09 (1)
B-C	-2097 / 0	-91.8	-91.8 0.53 (1)	4.16	C-D	-420 / 0	0.53 (1)
C-D	-1780 / 0	-91.8	-91.8 0.48 (1)	4.48	D-E	0 / 389	0.08 (1)
D-E	-1780 / 0	-91.8	-91.8 0.48 (1)	4.48	E-F	0 / 280	0.06 (1)
E-F	-1578 / 0	-91.8	-91.8 0.21 (1)	5.05	F-G	-449 / 0	0.28 (1)
F-G	-1578 / 0	-91.8	-91.8 0.21 (1)	5.05	G-H	0 / 280	0.06 (1)
G-H	-1780 / 0	-91.8	-91.8 0.48 (1)	4.48	H-I	-420 / 0	0.53 (1)
H-I	-1780 / 0	-91.8	-91.8 0.48 (1)	4.48	I-J	-194 / 35	0.09 (1)
I-J	-2097 / 0	-91.8	-91.8 0.53 (1)	4.16	J-K	0 / 1803	0.41 (1)
J-K	0 / 35	-91.8	-91.8 0.12 (1)	10.00	K-L	0 / 1803	0.41 (1)
T-B	-1839 / 0	0.0	0.0 0.19 (1)	6.18			
L-J	-1839 / 0	0.0	0.0 0.19 (1)	6.18			
T-S	0 / 0	-18.5	-18.5 0.16 (4)	10.00			
S-R	0 / 1775	-18.5	-18.5 0.36 (1)	10.00			
R-Q	0 / 1775	-18.5	-18.5 0.36 (1)	10.00			
Q-P	0 / 1481	-18.5	-18.5 0.29 (1)	10.00			
P-O	0 / 1481	-18.5	-18.5 0.29 (1)	10.00			
O-N	0 / 1775	-18.5	-18.5 0.36 (1)	10.00			
N-M	0 / 1775	-18.5	-18.5 0.36 (1)	10.00			
M-L	0 / 0	-18.5	-18.5 0.16 (4)	10.00			

TOTAL WEIGHT = 11 X 151 = 1666 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 8, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BOC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.08")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.53/1.00 (B-C:1), BC=0.36/1.00 (Q-S:1),
WB=0.53/1.00 (C-Q:1), SL=0.22/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE (GRIP) (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1997 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

SI GRIP= 0.84 (B) (INPUT = 0.90)
SI METAL= 0.57 (N) (INPUT = 1.00)

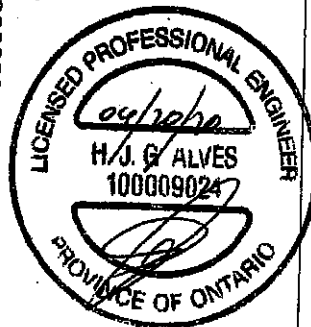


Structural component only
DWG# T-2006472

JOB NAME 408163	TRUSS NAME T5	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	-------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Fri Apr 17 08:46:41 2020 Page 1
ID:KIHNL?KlAuBVUgBrpOW7E8zls6y-iwGLVjIRD8VgOXMdedxjWKh71TKKlPGVvGzPDXC

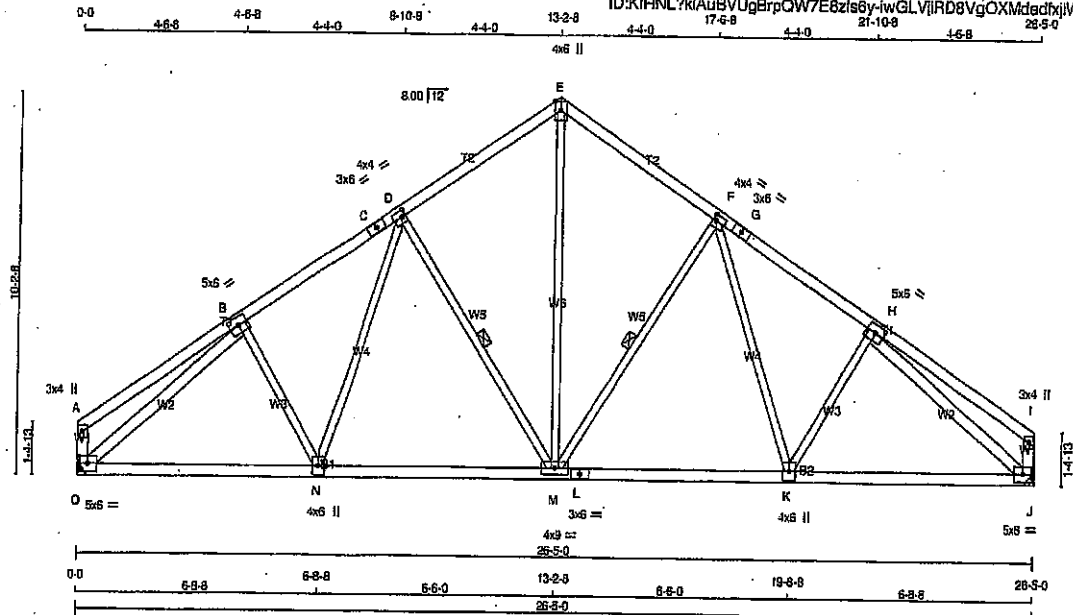

Scale = 1:57.2

TOTAL WEIGHT = 4 X 121 = 484 lb
[25] [F]

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
I - J	2x4	DRY	No.2	SPF
O - A	2x4	DRY	No.2	SPF
J - I	2x4	DRY	No.2	SPF
O - L	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF

ALL WEBS

EXCEPT	2x3	DRY	No.2	SPF
O - B	2x4	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B	TMWW-t	MT20	5.0	6.0		
C	TS-t	MT20	3.0	6.0		
D	TMWW-t	MT20	4.0	4.0	2.00	1.00
E	TTW+p	MT20	4.0	6.0	Edge	
F	TMWW-t	MT20	4.0	4.0	2.00	1.00
G	TS-t	MT20	3.0	6.0		
H	TMWW-t	MT20	5.0	6.0		
I	TMV+p	MT20	3.0	4.0		
J	BMVW-t	MT20	5.0	6.0		
K	BMVW-t	MT20	4.0	6.0		
L	BS-t	MT20	3.0	6.0		
M	BMVW-t	MT20	4.0	4.0		
N	BMVW-t	MT20	4.0	6.0		
O	BMVW-t	MT20	5.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	UPLIFT
O	1458	0	1458	0
J	1458	0	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT O, J. MINIMUM BEARING LENGTH AT JOINT O = 3-8, JOINT J = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	FERM. LIVE	WIND	DEAD	SOIL
O	1030	678 / 0	0 / 0	0 / 0	0 / 0	354 / 0	0 / 0
J	1030	678 / 0	0 / 0	0 / 0	0 / 0	354 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.05 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-M, D-M

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 21	-91.8	-91.8 0.23 (1)	M-E	0 / 985	0.22 (1)	
B-C	-1580 / 0	-91.8	-91.8 0.21 (1)	M-F	-511 / 0	0.23 (1)	
C-D	-1580 / 0	-91.8	-91.8 0.21 (1)	F-K	0 / 226	0.05 (1)	
D-E	-1198 / 0	-91.8	-91.8 0.21 (1)	K-H	-92 / 25	0.03 (1)	
E-F	-1188 / 0	-91.8	-91.8 0.21 (1)	D-M	-511 / 0	0.23 (1)	
F-G	-1580 / 0	-91.8	-91.8 0.21 (1)	N-D	0 / 228	0.05 (1)	
G-H	-1580 / 0	-91.8	-91.8 0.21 (1)	B-N	-92 / 25	0.03 (1)	
H-I	0 / 21	-91.8	-91.8 0.23 (1)	O-B	-1842 / 0	0.79 (1)	
O-A	-164 / 0	0.0	0.0 0.02 (1)	H-J	-1842 / 0	0.79 (1)	
J-I	-184 / 0	0.0	0.0 0.02 (1)				
O-N	0 / 1361	-18.5	-18.5 0.32 (1)				
N-M	0 / 1248	-18.5	-18.5 0.30 (1)				
M-L	0 / 1248	-18.5	-18.5 0.30 (1)				
L-K	0 / 1248	-18.5	-18.5 0.30 (1)				
K-J	0 / 1361	-18.5	-18.5 0.32 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.8	PSF
	DL =	5.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.88")
CALCULATED VERT. DEFL.(LL) = $L/899$ (0.05")
ALLOWABLE DEFL.(TL) = $L/360$ (0.88")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.11")

CSI: TC=0.23/1.00 (H-I:1), BC=0.32/1.00 (J-K:1), WB=0.79/1.00 (H-J:1), SS=0.16/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1997 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (M) (INPUT = 0.90)
JSI METAL= 0.45 (H) (INPUT = 1.00)

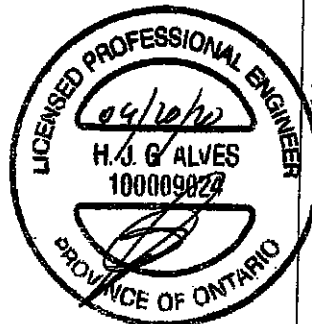

Structural component only
DWG# T-2006473

JOB NAME 408163	TRUSS NAME T6	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TAMMACK ROOF TRUSS, BURLINGTON					

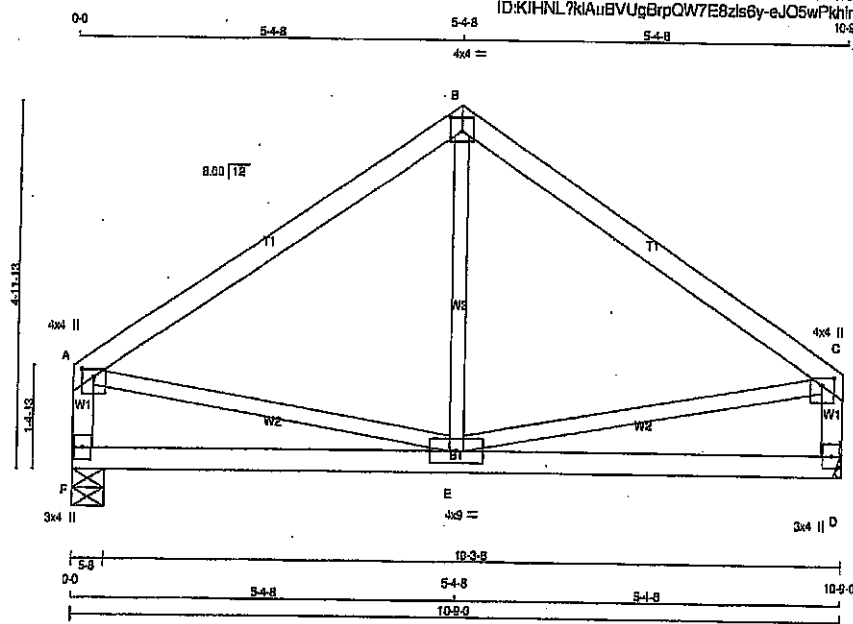

LUMBER

N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS			
A - B	2x4	DRY	No. 2
B - C	2x4	DRY	No. 2
F - A	2x4	DRY	No. 2
D - C	2x4	DRY	No. 2
F - D	2x4	DRY	No. 2

ALL WEBS 2x3 DRY No. 2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
A - B	MT20	4.0	4.0	1.25	2.00
B - C	MT20	4.0	4.0	2.25	2.00
C - D	MT20	4.0	4.0	1.25	2.00
D - E	MT20	3.0	4.0		
E - F	MT20	4.0	3.0		
F - A	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UP
F	593	0	593	0
D	593	0	593	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
F	419	275 / 0	0 / 0	0 / 0	144 / 0	0 / 0
D	419	275 / 0	0 / 0	0 / 0	144 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO. 2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	UNBRAC	MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX
		(LBS)	(PLF)	CSI (LC)			LENGTH		(LBS)	(PLF)	CSI (LC)		
FR-TO													
A-B	-428 / 0	-91.8	-91.8	0.34 (1)	6.25	E-B	20 / 85	0.03 (4)					
B-C	-428 / 0	-91.8	-91.8	0.34 (1)	6.25	A-E	0 / 362	0.08 (1)					
F-A	-554 / 0	0.0	0.0	0.08 (1)	7.81	E-C	0 / 362	0.08 (1)					
D-C	-554 / 0	0.0	0.0	0.08 (1)	7.81								
F-E	0 / 0	-18.5	-18.5	0.15 (4)	10.00								
E-D	0 / 0	-18.5	-18.5	0.15 (4)	10.00								

TOTAL WEIGHT = 2 X 41 = 82 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.36")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.36")
CALCULATED VERT. DEFL. (TL) = L/999 (0.02")

CSI: TC=0.34/1.00 (B-C:1), BC=0.15/1.00 (D-E:4), WB=0.09/1.00 (C-E:1), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 788 1937 1659

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.45 (C) (INPUT = 0.50)
JSI METAL = 0.13 (C) (INPUT = 1.00)



Structural component only
DWG# T-2006474

Version 8.810 S Oct 29 2019 MiTek Industries, Inc. Fri Apr 17 08:46:44 2020 Page 1
ID: KIHNL?kAuBVUgBrpQW7E8zls6y-6VvT7kV3lFF?4CKiDLn8p4zBliEiFJ5DKZRBzP(XG)
-1-3-8 1-3-8 0-0 5-4-8 5-4-8 10-4-0 5-4-8 1-3-8 12-0-8
4x4 =
Scale = 1/29.5




Structural component only
DWG# T-2006475

JOB NAME 408163	TRUSS NAME T8	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	-------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 14:48 2020 Page 1
ID:KIHNL?KIAuBVUGBrpQW7E8zls6y-mNKqMOyOu_rJm?URIMo7KOC9IACD8rdQgk8JhzPqJb
11-11-8
Scale = 1:19.0

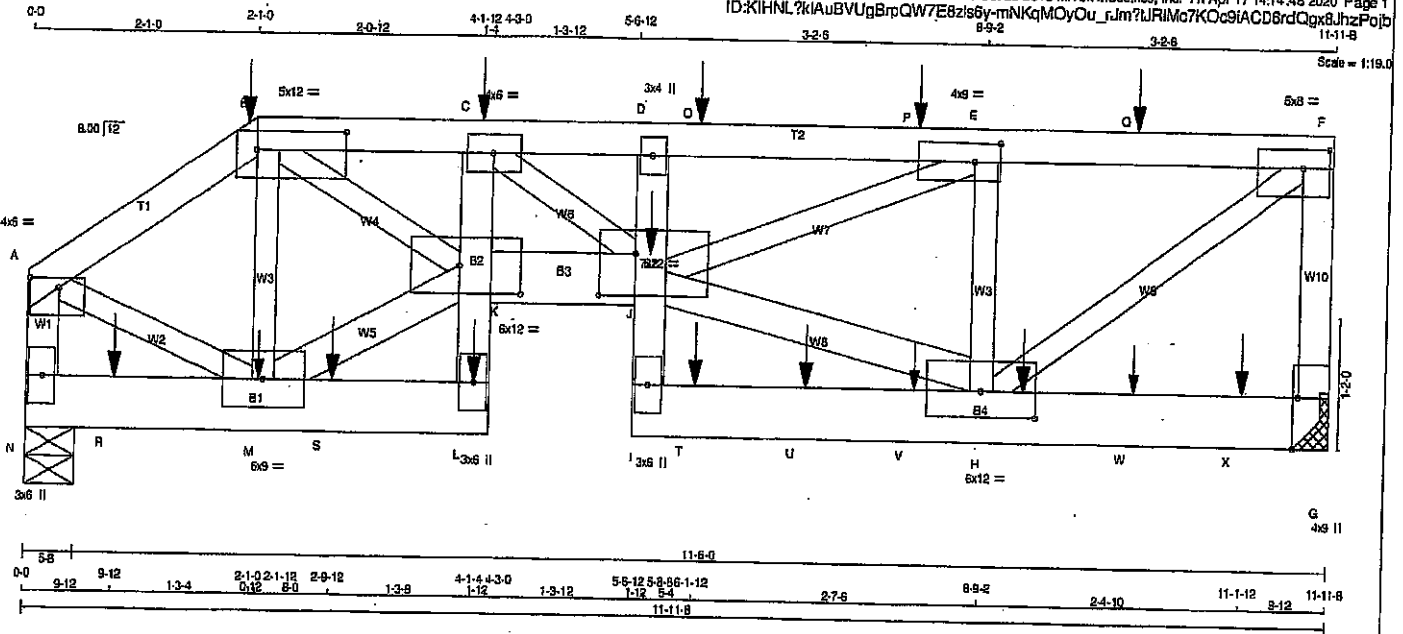

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF
B - F	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
N - A	2x4	DRY	No.2	SPF
N - L	2x6	DRY	No.2	SPF
L - C	2x4	DRY	No.2	SPF
K - J	2x6	DRY	No.2	SPF
I - D	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF

ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
M - K	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122'X3") SPIRAL NAILS		
A - B	12	SIDE(61.0)
B - F	12	SIDE(61.0)
F - G	12	TOP
N - A	12	TOP

BOTTOM CHORDS: (0.122'X3") SPIRAL NAILS	LOAD (PLF)
N - L	SIDE(0.0)
K - J	SIDE(61.0)
I - G	SIDE(183.1)
L - C	SIDE(29.4)
D - I	SIDE(316.3)

WEBS: (0.122'X3") SPIRAL NAILS	LOAD (PLF)
E - H	SIDE(192.0)
2x3	
2x4	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A TMWV-p	MT20	4.0	6.0	1.00	3.25
B TMWV-i	MT20	5.0	12.0	2.00	9.75
C TMWV-i	MT20	4.0	6.0		
D TMV-p	MT20	3.0	4.0		
E TMWV-i	MT20	4.0	9.0	2.00	2.75
F TMWV-i	MT20	5.0	8.0	2.00	3.00
G BMV-i	MT20	4.0	9.0	Edge	0.50
H BMWVW-i	MT20	6.0	12.0	2.75	6.00
I BMV-p	MT20	3.0	6.0		
J BMWVW-i	MT20	7.0	12.0	4.50	4.00
K BMWVW-i	MT20	6.0	12.0	3.00	6.75
L BMV-p	MT20	3.0	6.0		
M BMWVW-i	MT20	6.0	9.0		
N BMV-i	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
VERT				
HORZ				
G	5030	0	5030	0
N	4034	0	4034	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 4-0.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERMALIVE	WIND	DEAD	SOIL
COMBINED						
G	3552	2359.0	0.0	0.0	1193.0	0.0
N	2848	1909.0	0.0	0.0	936.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO							
A-B	-3843.0	-91.8	-91.8	0.08 (1)	4.77	M-B	-2179.0
B-C	-9543.0	-91.8	-91.8	0.40 (1)	2.87	C-J	0.2246
C-D	-11872.0	-91.8	-91.8	0.62 (1)	2.25	H-E	-2889.0
D-O	-11175.0	-91.8	-91.8	0.63 (1)	2.28	H-F	0.6454
O-P	-11175.0	-91.8	-91.8	0.63 (1)	2.36	A-M	0.3502
P-E	-11175.0	-91.8	-91.8	0.63 (1)	2.38	M-K	0.3191
E-Q	-5097.0	-91.8	-91.8	0.16 (1)	4.16	B-K	0.7537
Q-F	-5097.0	-91.8	-91.8	0.16 (1)	4.16	J-H	0.4983
G-F	-4078.0	0.0	0.0	0.29 (1)	5.87	J-E	0.6452
N-A	-3895.0	0.0	0.0	0.21 (1)	6.12		

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO							
A-B	0.0	-18.5	-18.5	0.10 (1)	10.00		
B-C	0.0	-18.5	-18.5	0.10 (1)	10.00		
M-S	0.374	-18.5	-18.5	0.12 (1)	10.00		
S-L	0.374	-18.5	-18.5	0.12 (1)	10.00		
L-K	0.657	0.0	0.0	0.39 (1)	10.00		
K-C	-1484.0	0.0	0.0	0.34 (1)	7.81		
K-J	0.9900	-18.5	-18.5	0.65 (1)	10.00		
J-I	0.877	0.0	0.0	0.52 (1)	10.00		
J-D	-22.24	0.0	0.0	0.48 (1)	7.81		
I-T	0.532	-18.5	-18.5	0.38 (1)	10.00		
T-U	0.532	-18.5	-18.5	0.38 (1)	10.00		
U-V	0.532	-18.5	-18.5	0.38 (1)	10.00		
V-H	0.532	-18.5	-18.5	0.38 (1)	10.00		
H-W	0.0	-18.5	-18.5	0.28 (1)	10.00		
W-X	0.0	-18.5	-18.5	0.28 (1)	10.00		
X-G	0.0	-18.5	-18.5	0.28 (1)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LOC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
B	2-1-0	-94	-94		BACK	VERT	TOTAL		C1
C	4-1-12	-4	-4		BACK	VERT	TOTAL		C1
H	9-1-12	-1438	-1438		FRONT	VERT	TOTAL		C1
J	5-8-8	-1446	-1446		FRONT	VERT	TOTAL		C1
L	4-1-4	-581	-581		FRONT	VERT	TOTAL		C1
L	4-1-4	-10	-10		BACK	VERT	TOTAL		C1
M	2-1-12	-1	-1		BACK	VERT	TOTAL		C1
O	5-1-12	-4	-4		BACK	VERT	TOTAL		C1
P	8-1-12	-4	-4		BACK	VERT	TOTAL		C1

TOTAL WEIGHT = 2 X 82 = 125 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 8.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (0.40")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.14")
ALLOWABLE DEFL.(TL) = 1/360 (0.40")
CALCULATED VERT. DEFL.(TL) = 1/558 (0.26")

CSI: TC=0.63/1.00 (D-E:1), BC=0.85/1.00 (J-K:1), WS=0.93/1.00 (B-K:1), SSI=0.32/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618	354
	1667	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (K) (INPUT = 0.90)

JSI METAL= 0.73 (K) (INPUT = 1.00)

Structural component only 1/2
DWG# T-2006476

CONTINUED ON PAGE 2

JOB NAME 408163	TRUSS NAME T8	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	


Version 8.310 S Oct 29 2019 M Tek Industries, Inc. Fri Apr 17 14:14:48 2020 Page 2
ID:KIHNL7kIAuBVUqBmQW7E8zls6v-mNKgMOvOu rJm?LIRMc7K0c9IACD6rdQqx8JhzPoiB

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
Q	10-1-12	-4	-4	---	BACK	VERT	TOTAL	---	C1
R	9-12	-702	-702	---	FRONT	VERT	TOTAL	---	C1
S	2-9-12	-574	-574	---	FRONT	VERT	TOTAL	---	C1
T	8-1-12	-6	-6	---	BACK	VERT	TOTAL	---	C1
U	7-1-12	-1438	-1438	---	FRONT	VERT	TOTAL	---	C1
V	8-1-12	-1	-1	---	BACK	VERT	TOTAL	---	C1
W	10-1-12	-1	-1	---	BACK	VERT	TOTAL	---	C1
X	11-1-12	-1439	-1439	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

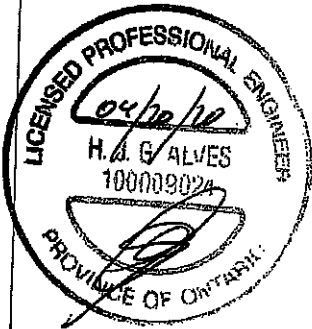

Handwritten mark

Structural component only
DWG# T-2006466

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Fri Apr 17 08:46:32 2020 Page 1
ID:KHNL?KIAuBVUgBrpQW7EBzls6y-TCDxcebknKNMyp9AudE7qarsqh76RQS7YLMqwoIzPiXL



<u>PLATES (table's in inches)</u>						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-i	MT20	3.0	4.0		
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TMB1-i	MT20	3.0	4.0		
F	BMW1+w	MT20	2.0	4.0		

UNFACTORED REACTIONS							
1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
B	198	142/0	0/0	0/0	0/0	56/0	0/0
D	198	142/0	0/0	0/0	0/0	56/0	0/0
F	208	125/0	0/0	0/0	0/0	89.0	0/0

LOADING
TOTAL LOAD CASES: (4)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (C-H:1), BC=0.12/1.00 (B-G:1).

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	818 254	1507 709	1522 1152


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TO -5.0°

DATE NOTATION TOL. = 5.0 Deg.

SI GRIP= 0.24 (B) (INPUT = 0.90)

S/ MEI AL= 0.06 (B) (INPUT = 1.00

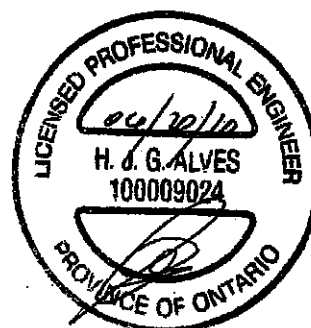


Structural component only
DWG# T-2006467

JOB NAME 408163	TRUSS NAME J1	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:49:21 2020 Page 1
ID: KIHNL?kAuBvUgBrpQW7E8zls6y-H43nktUw7zW7TqnTQIFvXhXOhMTLtkwp8fr7RzPjXW

Scale = 1:15.8

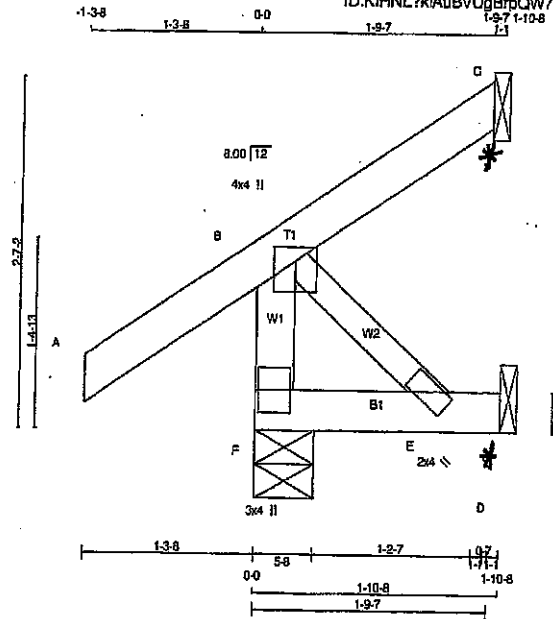

TOTAL WEIGHT = 3 X 9 = 27 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMW+w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
F	274	0	0	5-8
C	34	0	3-8	1-8
D	17	0	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LOASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	190	143 / 0	0 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0
C	23	19 / -27	0 / 0	0 / 0	0 / 0	0 / 0	4 / 0	0 / 0
D	14	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED HORIZ. LOAD (LC2)	MAX. FACTORED HORIZ. LOAD (LC3)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LC)
FR-TO						FR-TO		
F-B	-256 / 0	0.0	0.0	0.03 (1)	7.81	B-E	0 / 0	0.00 (1)
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00			
B-C	-27 / 0	-91.8	-91.8	0.12 (1)	6.25			
F-E	0 / 0	-18.5	-18.5	0.02 (4)	10.00			
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (E-F:4),
WB=0.00/1.00 (B-E:1), SSI=0.08/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION	(PSI)	(PL)	(PL)
MAX MIN MAX MIN MAX MIN			
MT20	618	354	1667
	768	1987	1656

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.80)
JSI METAL= 0.05 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006458

JOB NAME 408163	TRUSS NAME J2	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:48:22 2020 Page 1
ID:KIHNL7KjAuBVUgBrpQW7E8zls6y-IGc9WDTWhJ5NccPz18pUSkE4a5i4w_41oPOgtzPiXV

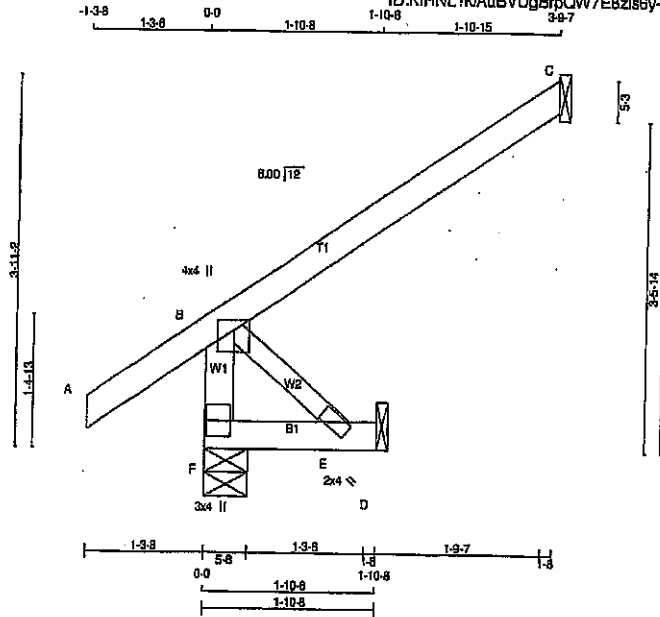

Scale = 1/2" = 1'-0"

LUMBER

N. L. G. A. RULES

CHORDS SIZE

F - B 2x4 DRY No.2

A - C 2x4 DRY No.2

F - D 2x4 DRY No.2

ALL WEBS 2x3 DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMVW+p	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
F	317	0	317	0	5-8	5-8
C	174	0	174	0	1-8	1-8
D	17	0	17	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LOASE		MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM	LIVE	WIND	DEAD	SOIL
F	220	167 / 0	0 / 0	0 / 0	0 / 0	0 / 0	53 / 0	0 / 0
C	120	97 / 0	0 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0
D	14	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (6)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LOC 1	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO			FR-TO				
F-B	-300 / 0	0.0	0.0	0.03 (1)	7.81	B-E	0 / 0	0.00 (1)	
A-B	0 / 35	-91.8	-91.8	0.13 (5)	10.00				
B-C	0 / 0	-91.8	-91.8	0.22 (1)	10.00				
F-E	0 / 0	-18.5	-18.5	0.02 (4)	10.00				
E-D	0 / 0	-18.5	-18.5	0.01 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 12 = 35 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")

CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")

ALLOWABLE DEFL. (TL) = $L/360$ (0.19")

CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CSI: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (E-F:4),

WB=0.00/1.00 (B-E:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLB) (PL)

MAX MIN MAX MIN MAX MIN


MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.21 (B) (INPUT = 0.90)

JSI METAL= 0.05 (B) (INPUT = 1.00)

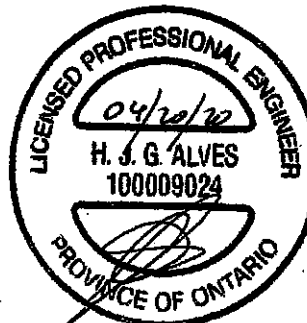

Structural component only
DWG# T-2006459

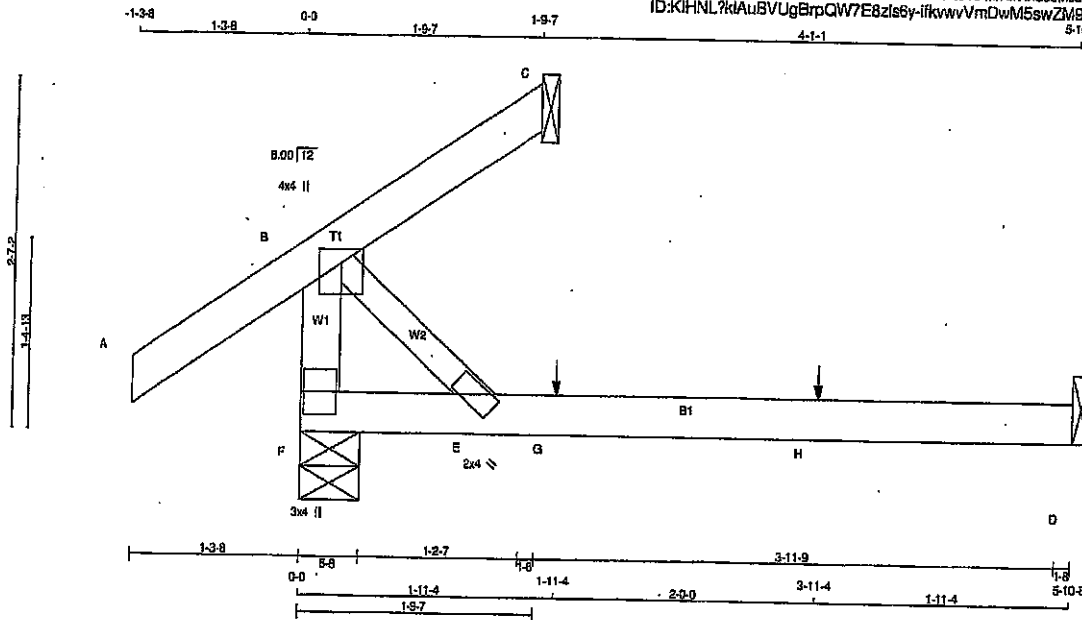

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	SPF
A - C	2x4	DRY	SPF
F - D	2x4	DRY	SPF

ALL WEBS 2x3 DRY No.2 SPF

DRY; SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMVW+w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	UPLIFT	IN-SX
F	311	0	0	5-8
C	34	0	0	1-8
D	54	0	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX/MIN. SNOW	MAX/MIN. LIVE	MAX/MIN. PERM. LIVE	MAX/MIN. WIND	MAX/MIN. DEAD	MAX/MIN. SOIL
F	220	143 / 0	0 / 0	0 / 0	0 / 0	77 / 0	0 / 0
C	23	19 / 0	0 / 0	0 / 0	0 / 0	4 / 0	0 / 0
D	43	0 / 0	0 / 0	0 / 0	0 / 0	43 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM	TO		FR-TO		
F-B	-258 / 0	0.0	0.0	0.03 (1)	7.81	B-E	0 / 0
A-B	0 / 35	-91.8	-91.8	0.13 (1)	10.00		0.00 (1)
B-C	-27 / 0	-91.8	-91.8	0.12 (1)	6.25		
F-E	0 / 0	-18.5	-18.5	0.13 (4)	10.00		
E-G	0 / 0	-18.5	-18.5	0.19 (4)	10.00		
G-H	0 / 0	-18.5	-18.5	0.19 (4)	10.00		
H-D	0 / 0	-18.5	-18.5	0.19 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	1-11.4	1	1	---	FRONT	VERT	TOTAL	---	C1
H	3-11.4	1	1	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 3 X 13 = 40 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.05")

CS: TC=0.13/1.00 (A-B:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.09/1.00 (B-C:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1556

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)

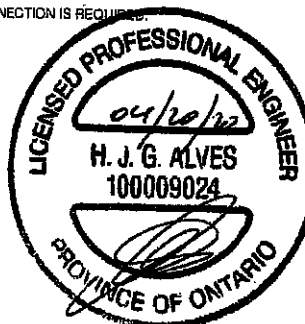


Structural component only
DWG# T-2006460

JOB NAME 408163	TRUSS NAME J4	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:48:25 2020 Page 1
ID:KIHNL7kiAuBVUgBrpQW7E8Zls6y-ArIH8FWO_EUxT47YIGNB4NsbqJinH-IWkmd2GczPjXS

Scale = 1:22.5

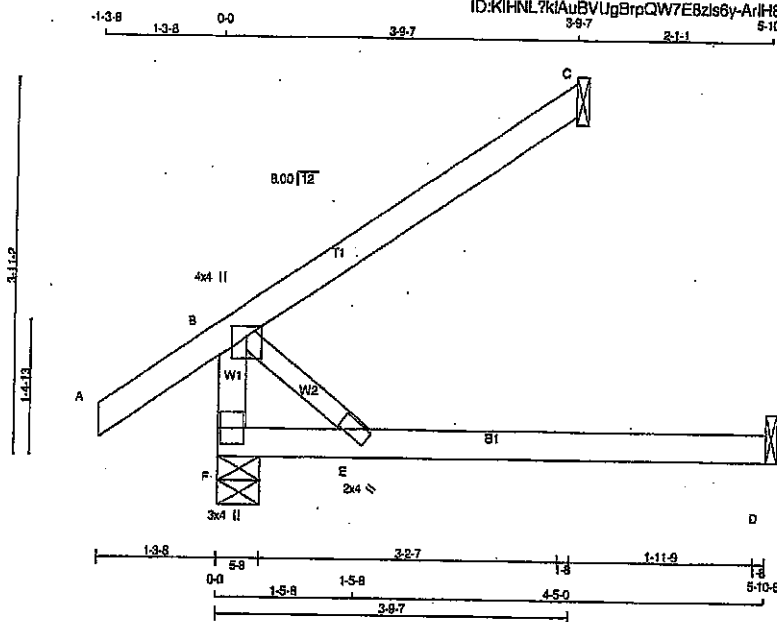

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TM/VW+p	MT20	4.0	4.0	1.25	2.00
E	BMW+w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ
JT	354	0	354	0
F	174	0	174	0
C	54	0	61	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	250	167/0	0/0	0/0	0/0	0/0	83/0	0/0
C	120	97/0	0/0	0/0	0/0	0/0	23/0	0/0
D	43	0/0	0/0	0/0	0/0	0/0	43/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED HORZ. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED HORZ. LOAD (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
F-B	-300/0	0.0	0.0	0.03 (1)	7.81	0/0	0.00 (1)
A-B	0/35	-91.8	-91.8	0.12 (1)	10.00		
B-C	0/0	-91.8	-91.8	0.22 (1)	10.00		
F-E	0/0	-18.5	-18.5	0.14 (4)	10.00		
E-D	0/0	-18.5	-18.5	0.19 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCG 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(85 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSK: TC=0.22/1.00 (B-C:1), BC=0.19/1.00 (D-E:4), WS=0.00/1.00 (B-E:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PLI)	SECTION (PLI)
(PSI)	(PSI)	(PSI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.30)
JSI METAL = 0.08 (B) (INPUT = 1.00)

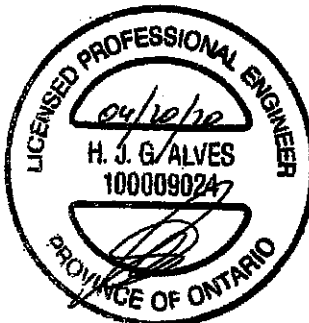


Structural component only
DWG# T-2006461

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408163	J5	11	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:46:28 2020 Page 1
ID:KIHNL?kIAuBVUgBrpQW7E8zls6y-e2sgLbX0IXco5EikG_uQcaOhii10ckzyQNopezPtXR

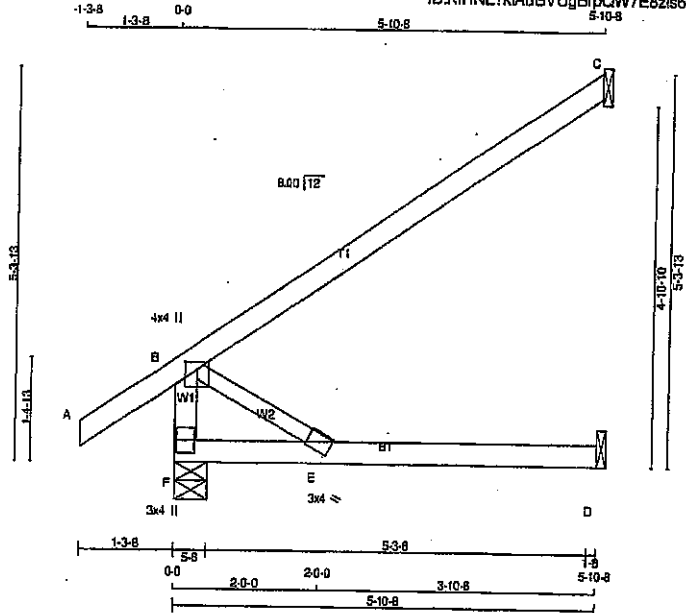

LUMBER

N.L.G.A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMVW+p	MT20	3.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS								
	FACTORED			MAXIMUM FACTORED			INPLT	REQRD
	GROSS REACTION			GROSS REACTION			BRG	BRG
JT	VERT	HORZ		DOWN	HORZ	UPLIFT	IN-SX	IN-SX
F	450	0		450	0	0	5-8	5-8
C	270	0		270	0	0	1-8	1-8
D	54	0		51	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	318	221 / 0	0 / 0	0 / 0	0 / 0	0 / 0	95 / 0	0 / 0
C	188	150 / 0	0 / 0	0 / 0	0 / 0	0 / 0	35 / 0	0 / 0
D	48	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	43 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE	VERT.	PLF	MEMB.	FORCE	MAX	CSF (LC)
FR-TO		FROM	TO	FR-TO			
F-B	-385 / 0	0.0	0.0	0.04 (1)	7.81	0 / 0	0.00 (1)
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00		
B-C	0 / 0	-91.8	-91.8	0.54 (1)	10.00		
F-E	0 / 0	-18.5	-18.5	0.17 (4)	10.00		
E-D	0 / 0	-18.5	-18.5	0.19 (4)	10.00		

TOTAL WEIGHT = 11 X 20 = 215 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.8	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 38.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = 1/360 (0.20")
CALCULATED VERT. DEFL. (LL) = 1/999 (0.00")
ALLOWABLE DEFL. (TL) = 1/360 (0.20")
CALCULATED VERT. DEFL. (TL) = 1/999 (0.05")

CSI: TC=0.54/1.00 (B-C:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MT20	518	354	1667
	788	1907	1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP = 0.28 (B) (INPUT = 0.90)

JSI METAL = 0.08 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006462

JOB NAME 408163	TRUSS NAME J6	QUANTITY 5	PLY. 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

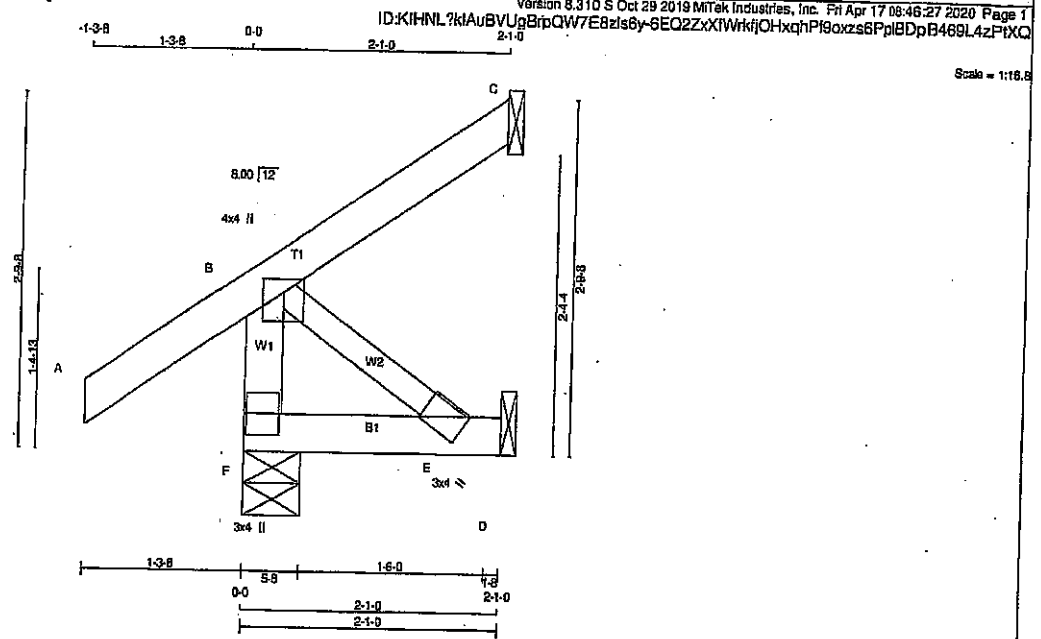

LUMBER

N. L. & A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMW+w	MT20	3.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REGRD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
F	241	0	241	0	5-8	5-8
C	98	0	98	0	1-8	1-8
D	19	0	22	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE		MAX. MIN. COMPONENT REACTIONS		PERM. LIVE WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	LIVE			
F	168	124 / 0	0 / 0	0 / 0	0 / 0	44 / 0	0 / 0
C	68	53 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0
D	15	0 / 0	0 / 0	0 / 0	0 / 0	15 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

MEMB.	CHORDS		FACTORED		MAX. UNBRACED LENGTH	MEMB.	WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	VERT. LOAD (LBS)	FACTORED VERT. LOAD (PLF)			MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)
F-B	-222 / 0	0.0	0.0	0.02 (1)	7.81	B-E	0 / 0	0.00 (1)
A-B	0 / 35	-91.8	-91.8	0.12 (5)	10.00			
B-C	0 / 0	-91.8	-91.8	0.07 (1)	10.00			
F-E	0 / 0	-18.5	-18.5	0.02 (4)	10.00			
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 5 X 10 = 49 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CS: TO=0.12/1.00 (A-B:5), BC=0.02/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SS=0.09/1.00 (A-B:5)

DOL LUMBER-1.00 NAIL-1.00 LB BEND-1.10
COMP-1.10 SHEAR-1.10 TENS-1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.15 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)



JOB NAME 408163	TRUSS NAME J7	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:48:28 2020 Page 1
ID:KIHNL7kIAuBVUgBrpQW7E8zls6y-aQ_QmGYHH9sWKXs7COwui?U5rWimUeTyCksjXzPjXP

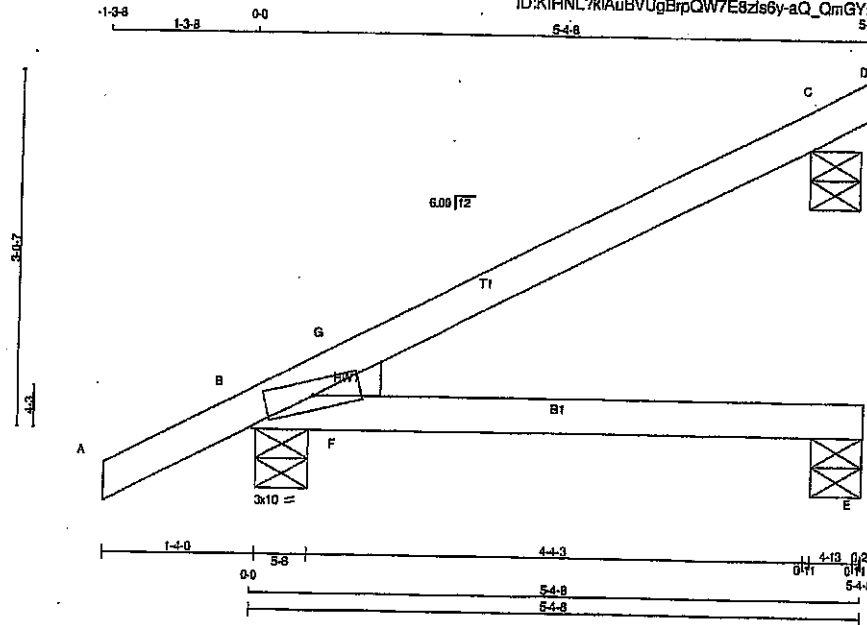

Scale = 1:16.2

LUMBER

N. L. G. A. RULES	
CHORDS	SIZE
A - D	2x4 DRY
B - E	2x4 DRY
	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMBH1-m	MT20	3.0	10.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX	HEEL WEDGE
	VERT	HORZ	DOWN	HORZ			
B	409	0	409	0	5-8	5-8	2x4 L
E	80	0	80	0	5-8	5-8	
C	235	0	235	0	5-8	5-8	

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): G

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX./MIN. COMPONENT REACTIONS					SOIL
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	
B	237	201/0	0/0	0/0	0/0	88/0	0/0
E	59	21/0	0/0	0/0	0/0	38/0	0/0
C	162	125/0	0/0	0/0	0/0	38/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD			MAX. UNBRACED LENGTH	WEBS MAX. FACTORED FORCE (LBS)
		FROM	TO	CSI (LC)		
FR-TO						
A-B	0/26	-91.8	-91.8	0.12 (1)	10.00	
B-G	-23/0	-91.8	-91.8	0.08 (4)	8.25	F-G -191/14 0.00 (1)
G-C	0/4	-91.8	-91.8	0.30 (1)	10.00	
C-D	-7/0	-91.8	-91.8	0.01 (1)	10.00	
B-F	0/0	-18.5	-18.5	0.23 (1)	10.00	
F-E	0/0	-18.5	-18.5	0.23 (1)	10.00	

TOTAL WEIGHT = 2 X 15 = 31 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.5	PSF
	DL	=	5.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.5 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/599$ (0.05")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/664$ (0.10")

CSI: TC=0.30/1.00 (C-G:1), BC=0.23/1.00 (E-F:1),
WB=0.00/1.00 (F-G:1), SS=0.16/1.00 (B-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1567 788 1987 1988

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.11 (B) (INPUT = 0.90)
JSI METAL = 0.03 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006464

JOB NAME 408163	TRUSS NAME J8	QUANTITY 8	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.31Q 5 Oct 29 2019 MTEK Industries, Inc. Fri Apr 17 08:46:30 2020 Page 1
ID:KIHNL7kAuBVUpBpQW7E8zls8y-Wp5AByaXom6Ear0WVpyMnQZSWKPMYyFt2LpyPzP1XN

Scale: 3/4"=1'

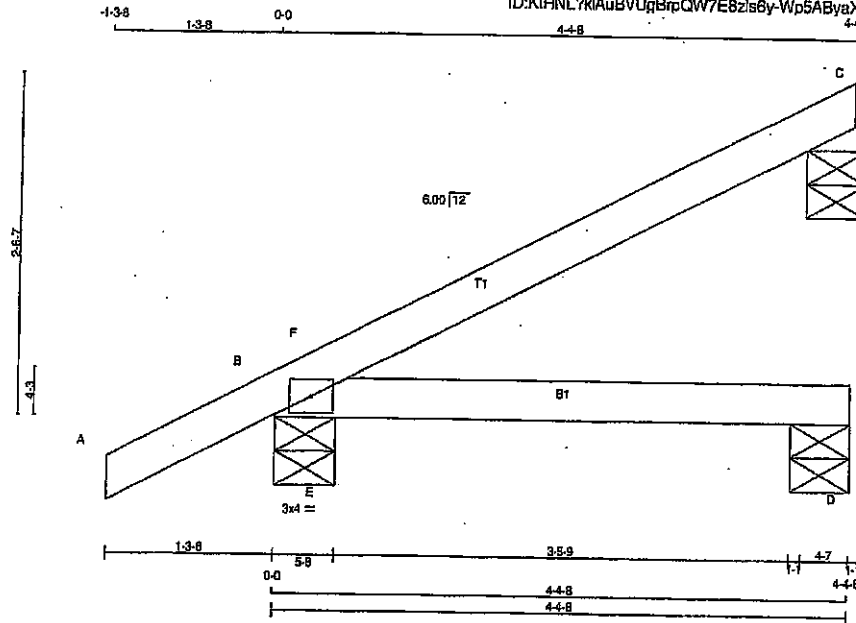

LUMBER

N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
A - C	2x4	DRY	No.2
B - D	2x4	DRY	No.2

DRY, SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
C	175	0	175	0	5-8 (4-6)	5-8
B	366	0	366	0	5-8	5-8
D	66	0	66	0	5-8 (5-7)	5-8

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
C	121	94/0	0/0	0/0	0/0	27/0	0/0
B	256	181/0	0/0	0/0	0/0	75/0	0/0
D	49	18/0	0/0	0/0	0/0	32/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0/26	-91.8 -91.8	0.12 (1)	10.00	E-F	-280/6	0.00 (1)
B-F	-20/37	-91.8 -91.8	0.05 (1)	6.25			
F-C	-3/2	-91.8 -91.8	0.23 (1)	10.00			
B-E	0/0	-18.5 -18.5	0.16 (1)	10.00			
E-D	0/0	-18.5 -18.5	0.16 (1)	10.00			

TOTAL WEIGHT = 8 X 12 = 96 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.02")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.04")

CSI: TC=0.23/1.00 (C-F:1), BC=0.18/1.00 (D-E:1),
WB=0.00/1.00 (E-F:1), SSI=0.23/1.00 (B-E:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MT20	818	354
	1667	788
	1987	1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.29 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)

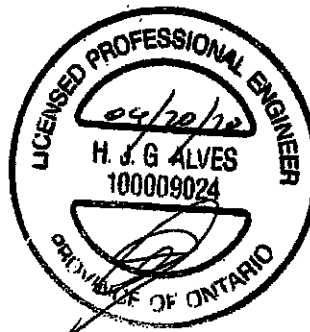

Structural component only
DWG# T-2006465

JOB NAME 408165	TRUSS NAME T34	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:44:26 2020 Page 1
 ID:Ovhlky48Q0cPQa_Y353NoTWzicKo-9ycl9Z4f7gUqinXgEnk-HHQD_K29u06?MNFbzPzZ

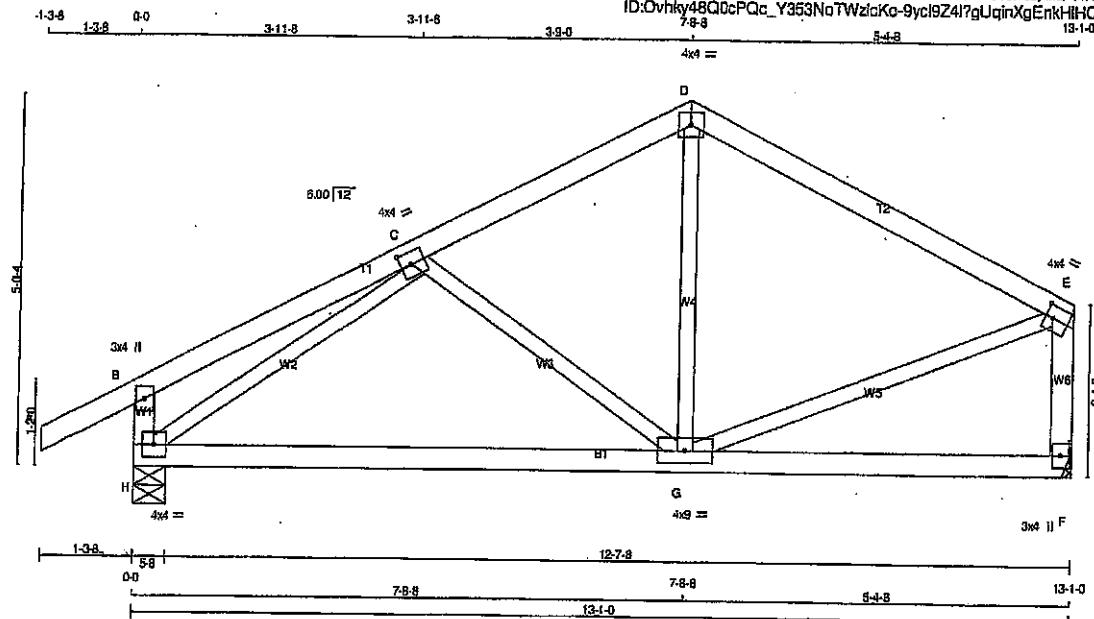

Scale = 1:25.5

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4 DRY	No.2	SPF
D - E	2x4 DRY	No.2	SPF
H - B	2x4 DRY	No.2	SPF
F - E	2x4 DRY	No.2	SPF
H - F	2x4 DRY	No.2	SPF
ALL WEBS EXCEPT	2x3 DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+P	MT20	3.0	4.0		
C	TMVW+I	MT20	4.0	4.0	2.00	1.75
D	TTW+P	MT20	4.0	4.0		
E	TMVW+I	MT20	4.0	4.0	2.00	1.25
F	BMV+P	MT20	3.0	4.0		
G	BMVW+I	MT20	4.0	9.0		
H	BMVW+I	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	VERT	GROSS REACTION	HORZ	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
F	721	0	721	0	0	5-8	5-8		
H	846	0	846	0	0	5-8	5-8		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1'-8".

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	510	335 / 0	0 / 0	0 / 0	0 / 0	175 / 0	0 / 0
H	596	404 / 0	0 / 0	0 / 0	0 / 0	192 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (LBS)
PR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	C-G	-275 / 0	0.10 (1)
B-C	0 / 18	-91.8	-91.8 0.21 (1)	10.00	G-D	0 / 124	0.04 (4)
C-D	-594 / 0	-91.8	-91.8 0.17 (1)	6.25	H-C	-888 / 0	0.33 (1)
D-E	-566 / 0	-91.8	-91.8 0.34 (1)	6.25	G-E	0 / 541	0.12 (1)
H-B	-282 / 0	0.0	0.0 0.03 (1)	7.81			
F-E	-690 / 0	0.0	0.0 0.09 (1)	7.81			
H-G	0 / 728	-18.5	-18.5 0.30 (4)	10.00			
G-F	0 / 0	-18.5	-18.5 0.25 (4)	10.00			

TOTAL WEIGHT = 4 X 52 = 207 lb

(M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.44")
 CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
 ALLOWABLE DEFL. (TL) = L/360 (0.44")
 CALCULATED VERT. DEFL. (TL) = L/999 (0.10")

CSK TO=0.34/1.00 (D-E:1), BC=0.30/1.00 (G-H:4), WB=0.33/1.00 (C-H:1), SS=0.17/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1667 788 1987 1655	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.86 (E) (INPUT = 0.90)

JSI METAL = 0.28 (C) (INPUT = 1.00)

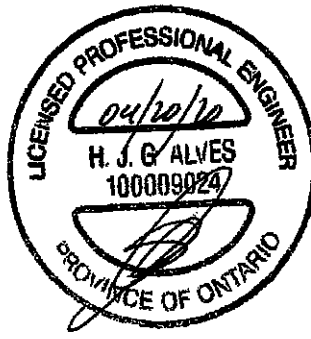


Structural component only
 DWG# T-2006496

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408165	T34CP	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 8 Oct 2019 Mitek Industries, Inc. Fri Apr 17 08:44:27 2020 Page 1
ID:Ovhky48Q0cPQc_Y353NoTWzlcKo-d8AhNu4NmzchJx6toUFWUzOkkOOdrMBbP2p71zPlZl

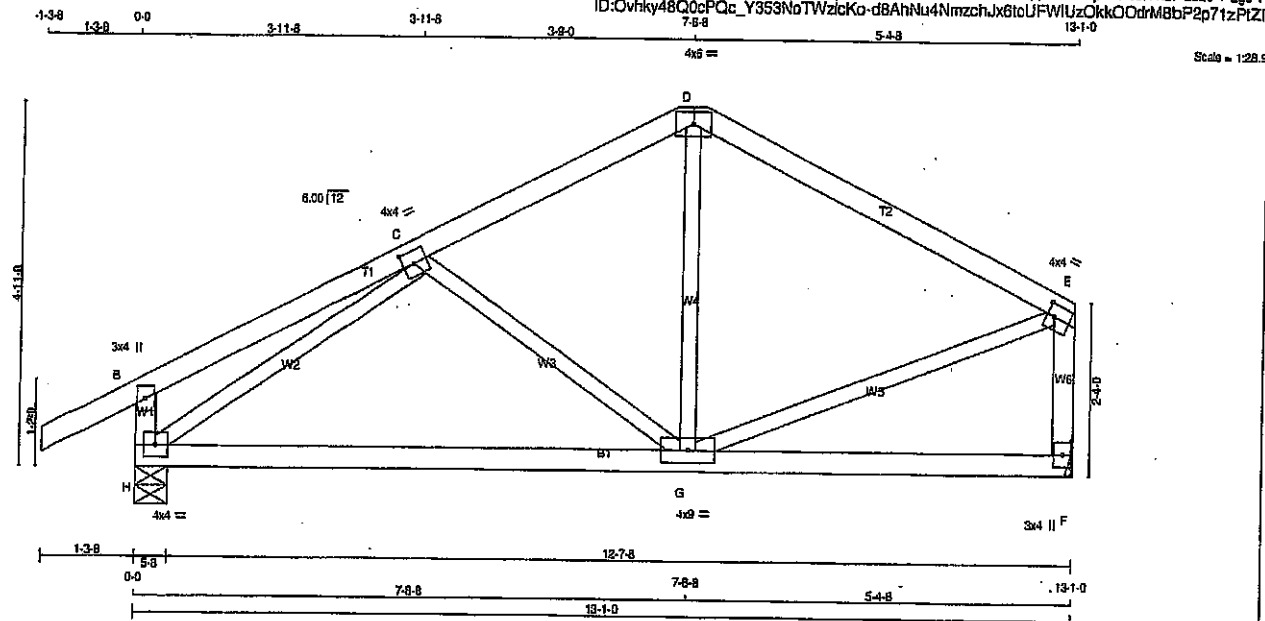

TOTAL WEIGHT = 52 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - E	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT DRY, SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0		
C	TMVW-1	MT20	4.0	4.0	2.00	1.75
D	TTW-p	MT20	4.0	6.0		
E	TMVW-1	MT20	4.0	4.0	2.00	1.25
F	BMV1-p	MT20	3.0	4.0		
G	BMVWV-1	MT20	4.0	9.0		
H	BMVWV-1	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	UPLIFT	IN-SX
F	721	0	721	0
H	846	0	846	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	510	335 / 0	0 / 0	0 / 0	0 / 0	175 / 0	0 / 0
H	596	404 / 0	0 / 0	0 / 0	0 / 0	192 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD LC1 (PLF)	CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	FORCE (LBS)	MAX CS1 (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	C-G	-275 / 0
B-C	0 / 18	-91.8	-91.8	0.21 (1)	10.00	G-D	0 / 124
C-D	-584 / 0	-91.8	-91.8	0.17 (1)	6.25	H-C	-898 / 0
D-E	-588 / 0	-91.8	-91.8	0.34 (1)	6.25	G-E	0 / 541
H-B	-262 / 0	0.0	0.0	0.03 (1)	7.81		
F-E	-690 / 0	0.0	0.0	0.09 (1)	7.81		
H-G	0 / 728	-18.5	-18.5	0.30 (4)	10.00		
G-F	0 / 0	-18.5	-18.5	0.25 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 8.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.44")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.44")
CALCULATED VERT. DEFL.(TL) = L/999 (0.10")

CS1: TO=0.34/1.00 (D-E), BC=0.30/1.00 (G-H4), WB=0.33/1.00 (G-H1), SS=0.17/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 768

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (E) (INPUT = 0.90)


JSI METAL= 0.28 (C) (INPUT = 1.00)

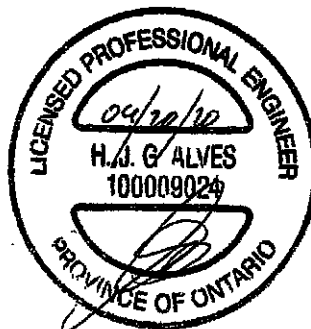

Structural component only
DWG# T-2006497

JOB NAME 408165	TRUSS NAME T21	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Road Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:44:20 2020 Page 1
 ID:Ovhky48Q0cPQg_Y355NoTWzlcKo-KoF1vV7_Cqkh_s4XuWdtW0BAKwy8Vdn7_gxOxPZP
 1-3-8 00 5-10-8 5-10-8 5-1-2 10-11-10 4-11-14 15-11-8 4-11-14 20-11-8 5-1-2 25-0-8 5-10-8 31-11-0 33-2-8
 Scale = 1:52.6

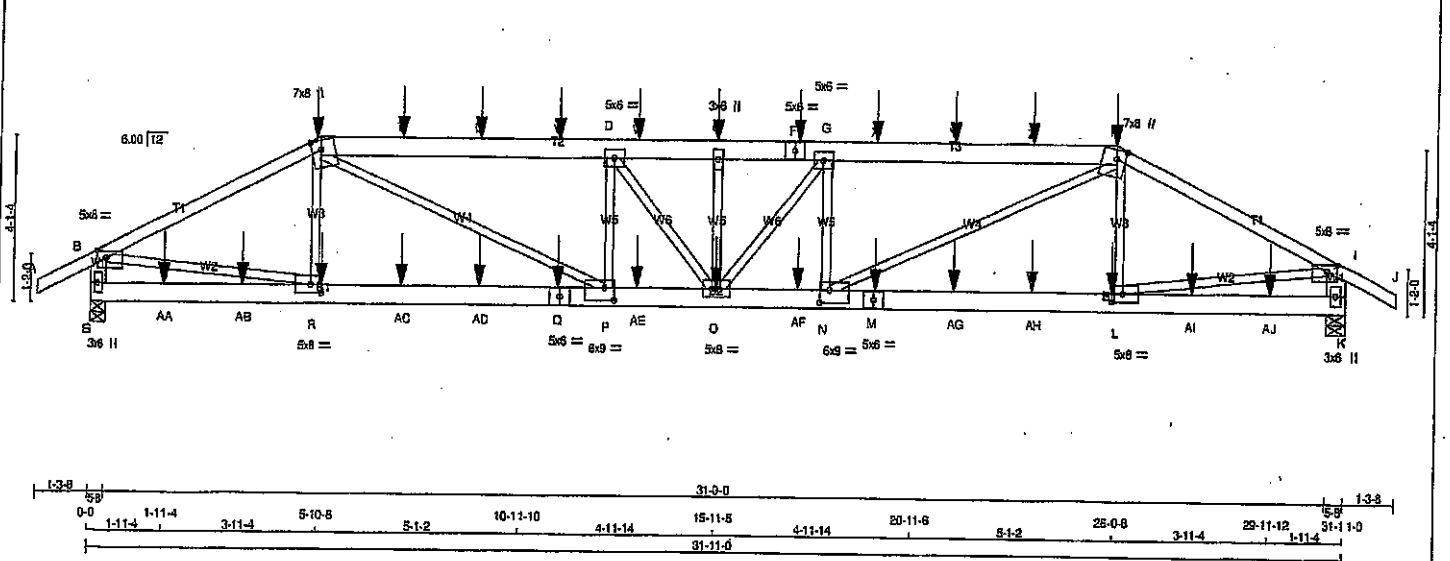

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR
A - C	2x4	DRY	No.2	SPF
C - F	2x6	DRY	No.2	SPF
F - H	2x8	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF
S - B	2x6	DRY	No.2	SPF
K - I	2x6	DRY	No.2	SPF
S - Q	2x6	DRY	No.2	SPF
Q - M	2x6	DRY	No.2	SPF
M - K	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY; SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS	ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS			
A - C	1	12	SIDE(61.0)
H - J	1	12	SIDE(61.0)
C - F	2	12	SIDE(183.1)
F - H	2	12	SIDE(61.0)
S - B	2	12	TOP
K - I	2	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS			
S - Q	2	12	SIDE(183.1)
Q - M	2	12	SIDE(183.1)
M - K	2	12	SIDE(183.1)
WEBS: (0.122"x3") SPIRAL NAILS			
2x3	1	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	2.00	3.25
C	TTWW-m	MT20	7.0	8.0	2.75	2.75
D	TMVW-i	MT20	5.0	8.0		
E	TMVW-w	MT20	3.0	8.0		
F	TS-i	MT20	5.0	6.0		
G	TMVW-i	MT20	5.0	6.0		
H	TTWW-m	MT20	7.0	8.0	2.75	2.75
I	TMVW-p	MT20	5.0	8.0	2.00	3.25
K	BMV-i	MT20	3.0	6.0		
L	BMVW-i	MT20	5.0	8.0	2.50	3.25
M	BS-i	MT20	5.0	6.0		
N	BMVW-i	MT20	6.0	9.0	3.75	3.00
O	BMVW-i	MT20	5.0	8.0		
P	BMVW-i	MT20	6.0	9.0	3.75	3.00
Q	BS-i	MT20	5.0	6.0		
R	BMVW-i	MT20	5.0	8.0	2.50	3.25
S	BMV-i	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	UP/LIFT
S	3035	0	3035	0
K	3034	0	3034	0

UNFACTORED REACTIONS

1ST CASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	2146	1410 / 0	0 / 0	0 / 0	736 / 0	0 / 0
S	2146	1408 / 0	0 / 0	0 / 0	736 / 0	0 / 0
K	2145	1408 / 0	0 / 0	0 / 0	736 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.07 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	FACTORED MAX. CSI (LC)	
FR-TO		FROM TO			FR-TO			
A-B	0 / 28	-91.8	-91.8	0.07 (1)	10.00	R-C	-311 / 77	0.04 (1)
B-C	-4576 / 0	-91.8	-91.8	0.48 (1)	4.07	C-P	0 / 2765	0.34 (1)
C-T	-6582 / 0	-91.8	-91.8	0.38 (1)	4.33	P-D	-1050 / 0	0.13 (1)
T-U	-6582 / 0	-91.8	-91.8	0.35 (1)	4.33	D-O	-109 / 0	0.02 (1)
U-V	-6582 / 0	-91.8	-91.8	0.36 (1)	4.33	O-E	0 / 191	0.02 (1)
V-W	-6582 / 0	-91.8	-91.8	0.36 (1)	4.33	E-G	-105 / 0	0.02 (1)
D-W	-6516 / 0	-91.8	-91.8	0.23 (1)	4.40	N-G	-1059 / 0	0.13 (1)
W-E	-6516 / 0	-91.8	-91.8	0.23 (1)	4.40	N-H	0 / 2763	0.34 (1)
E-F	-6516 / 0	-91.8	-91.8	0.23 (1)	4.40	L-H	-311 / 77	0.04 (1)
F-G	-6516 / 0	-91.8	-91.8	0.23 (1)	4.40	B-R	0 / 4138	0.51 (1)
G-X	-6580 / 0	-91.8	-91.8	0.36 (1)	4.33	L-I	0 / 4137	0.51 (1)
X-Y	-6580 / 0	-91.8	-91.8	0.36 (1)	4.33			
Y-Z	-6580 / 0	-91.8	-91.8	0.36 (1)	4.33			
Z-H	-6580 / 0	-91.8	-91.8	0.36 (1)	4.33			
H-I	-4574 / 0	-91.8	-91.8	0.48 (1)	4.07			
I-J	0 / 28	-91.8	-91.8	0.07 (1)	10.00			
S-B	-2972 / 0	0.0	0.0	0.10 (1)	7.81			
K-I	-2971 / 0	0.0	0.0	0.10 (1)	7.81			

09/20/12

H. J. G. ALVEE

100009024

PROFESSIONAL

ENGINEER

STATE OF OHIO

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-457	-457	-	FRONT	VERT	TOTAL	-	C1
E	15-11-8	-110	-110	-	FRONT	VERT	TOTAL	-	C1
F	17-11-12	-110	-110	-	FRONT	VERT	TOTAL	-	C1

TOTAL WEIGHT = 2 X 155 = 311 LB

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCG 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 085-08, CSA 086-14
- TPC 2011, TPC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06")
CALCULATED VERT. DEFL.(LL) = L/999 (0.16")
ALLOWABLE DEFL.(TL) = L/360 (1.06")
CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CSI: TC=0.48/1.00 (B-C:1), BC=0.47/1.00 (D-P:1), WB=0.51/1.00 (B-R:1), SS=0.20/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR	SECTION
(PSI) (PLI)	(PLI) (PLI)
MAX MIN MAX MIN	MAX MIN MAX MIN
MT20	618 354 1687 788 1987 1688

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.54 (R) (INPUT = 0.90)
JSI METAL = 0.40 (M) (INPUT = 1.00)



Structural component only 1/2
DWG# T-2006487

CONTINUED ON PAGE 2

JOB NAME 408165	TRUSS NAME T21Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oc 29 2019 Mitak Industries, Inc. Fri Apr 17 08:44:21 2020 Page 1

ID:Ovhky48Q0cPQc_Y353NoTWzicKo-o7pP6r0cB7sYb0jRD862DjHvKByE7sGDubVwOzP1ZO

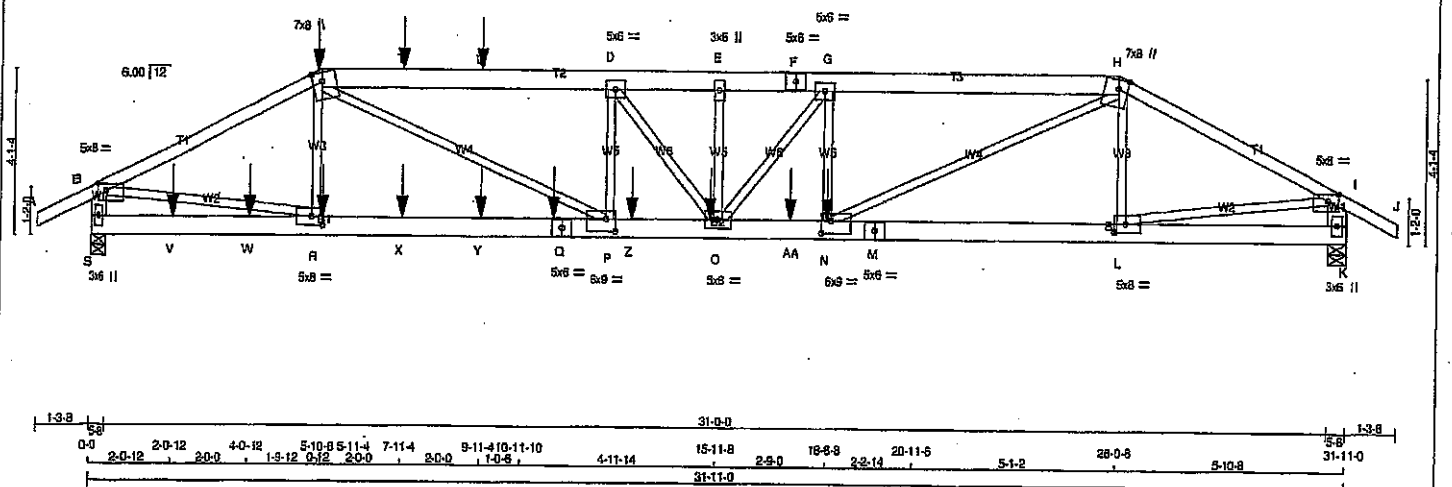

TOTAL WEIGHT = 2 X 155 = 311 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	SPF
A - C	2x4	DRY	No.2	SPF		
C - F	2x6	DRY	No.2	SPF		
F - H	2x6	DRY	No.2	SPF		
H - J	2x4	DRY	No.2	SPF		
S - B	2x6	DRY	No.2	SPF		
K - I	2x6	DRY	No.2	SPF		
S - Q	2x6	DRY	No.2	SPF		
Q - M	2x6	DRY	No.2	SPF		
M - K	2x6	DRY	No.2	SPF		
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF		

DRY: SEASONED LUMBER.
DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C 1	12	SIDE(61.0)
H-J 1	12	TOP
C-F 2	12	SIDE(61.0)
F-H 2	12	TOP
S-B 2	12	TOP
K-I 2	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
S-Q 2	12	SIDE(183.1)
Q-M 2	12	SIDE(183.1)
M-K 2	12	TOP
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1	6	SIDE(300.5)
G-N 1	6	SIDE(300.5)

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.
TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.
SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (tablets in inches)	W.	LEN	Y	X
JT TYPE PLATES				
B TMVW-p MT20	5.0	8.0	2.00	3.25
C TTVW-m MT20	7.0	8.0	2.75	2.75
D TMVW-t MT20	5.0	6.0		
E TMVW-w MT20	3.0	8.0		
F TS-t MT20	5.0	6.0		
G TMVW-t MT20	5.0	8.0		
H TTVW-m MT20	7.0	8.0	2.75	2.75
I TMVW-p MT20	5.0	8.0	2.00	3.25
K BMV1+p MT20	3.0	8.0		
L BMVW-t MT20	5.0	8.0	2.50	3.25
M BS-t MT20	5.0	6.0		
N BMVW-t MT20	8.0	9.0	3.75	3.00
O BMVW-t MT20	5.0	8.0		
P BMVW-t MT20	6.0	8.0	3.75	3.00
Q BS-t MT20	5.0	6.0		
R BMVW-t MT20	5.0	8.0	2.50	3.25
S BMV1+p MT20	3.0	8.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	4661	0	0	5-8
S	4661	0	0	5-8
K	4115	0	0	5-8

UNFACTORED REACTIONS	1ST LOOSE	MAX/MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
JT COMBINED	SNOW	LIVE	PERM.LIVE		
S	3289	2187 / 0	0 / 0	0 / 0	1092 / 0
K	2801	1954 / 0	0 / 0	0 / 0	947 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.09 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. FACTORED (PLF)	FACTORED (PLF)	MAX. FACTORED (PLF)	MAX. FACTORED (PLF)	MAX. FACTORED (PLF)	MAX. FACTORED (PLF)
FR-TO									
A-B	0 / 28								
B-C	-7526 / 0								
C-T	-11598 / 0								
T-U	-11598 / 0								
U-D	-11598 / 0								
D-E	-11893 / 0								
E-F	-11893 / 0								
F-G	-11893 / 0								
G-H	-11804 / 0								
H-I	-6538 / 0								
I-J	0 / 25								
S-B	-4635 / 0								
K-I	-4078 / 0								
S-V	0 / 0								
V-W	0 / 0								
W-R	0 / 0								
R-X	0 / 6747								
X-Y	0 / 6747								
Y-Q	0 / 6747								
Q-P	0 / 6747								
P-Z	0 / 11598								
Z-O	0 / 11598								
O-AA	0 / 11803								
AA-N	0 / 11803								
N-M	0 / 5878								
M-L	0 / 5878								
L-K	0 / 0								

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX+	FACE	DIF.	TOTAL	C1
C	5-10-8	-380	-380			BACK	VERT		
N	18-8-8	-1854	-1854			BACK	VERT		
O	15-9-4	-459	-459			BACK	VERT		
Q	11-9-4	-459	-459			BACK	VERT		
R	5-11-4	-256	-256			BACK	VERT		
T	7-11-4	-33	-33			BACK	VERT		
U	9-11-4	-33	-33			BACK	VERT		
V	2-0-12	-41	-41			BACK	VERT		
W	4-0-12	-81	-81			BACK	VERT		
X	7-11-4	-256	-256			BACK	VERT		
Y	9-11-4	-256	-256			BACK	VERT		
Z	13-9-4	-459	-459			BACK	VERT		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")
CALCULATED VERT. DEFL.(LL) = L/899 (0.29")
ALLOWABLE DEFL.(TL) = L/360 (1.08")
CALCULATED VERT. DEFL.(TL) = L/717 (0.53")

CSI: TC=0.75/1.00 (B-C-I), BC=0.94/1.00 (N-O-I), WB=0.84/1.00 (B-R-I), SSI=0.23/1.00 (P-R-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES	PLATE GRIP(DRY)	PLATE GRIP(WET)	PLATE GRIP(SHED)	PLATE GRIP(SHED)
	(PS)	(PL)	(PS)	(PL)
	MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (N) (INPUT = 0.90)
JSI METAL= 0.73 (M) (INPUT = 1.00)

Structural component only 1/2
DWG# T-2008488
CONTINUED ON PAGE 2

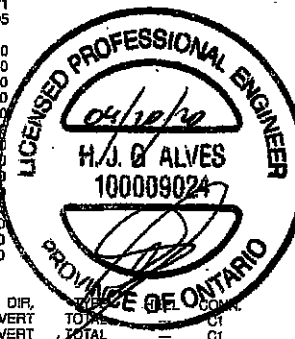

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408165	T21	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			


Version B.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:44:20 2020 Page 2
ID:Ovnhkv48Q0cPOc Y353NoTWzicKo-KoF1vV? Qqktr s4XuWdtW0BAKwy8Vdn7 qnOxzPIZP

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
H	26-0-8	-457	-457	---	FRONT	VERT	TOTAL	---	C1
L	26-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
M	19-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
O	15-11-8	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Q	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	19-11-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	21-11-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	23-11-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AB	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AC	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AD	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AE	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	17-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	21-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	23-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	27-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	29-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

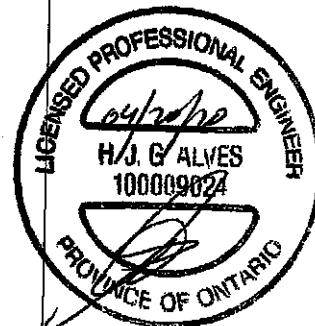

72


JOB NAME 408165	TRUSS NAME T22	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Rooftruss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Fri Apr 17 08:44:21 2020 Page 1

ID:1ebEM4Ce92xm94Zv7jkFPizmBR3-q?pp6r0aB7sYb0fjRD862DjKbKHRE1R3DUbVwOzP1Z0

Scale = 1:52.6

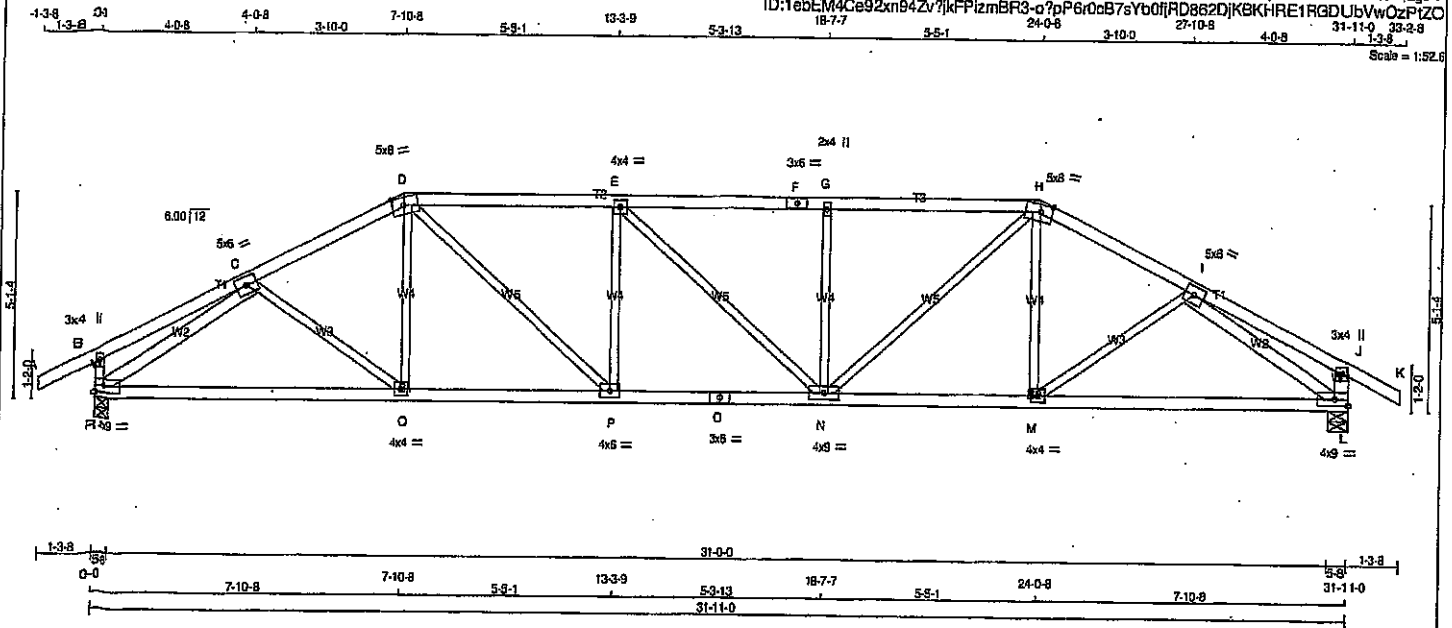

TOTAL WEIGHT = 130 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - K	2x4	DRY	No.2	SPF
R - B	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
R - O	2x4	DRY	No.2	SPF
O - L	2x4	DRY	No.2	SPF

ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
R - C	2x4	DRY	No.2	SPF
I - L	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-t	MT20	5.0	6.0		
D	TMVW-m	MT20	5.0	8.0	2.25	3.50
E	TMVW-t	MT20	4.0	4.0		
F	TS-1	MT20	3.0	6.0		
G	TMVW-w	MT20	2.0	4.0		
H	TMVW-m	MT20	5.0	8.0	2.25	3.50
I	TMVW-t	MT20	5.0	6.0		
J	TMV+p	MT20	3.0	4.0		
L	BMVW1-t	MT20	4.0	9.0		Edge
M	BMVW-t	MT20	4.0	4.0		
N	BMVW-t	MT20	4.0	9.0		
O	BS-1	MT20	3.0	6.0		
P	BMVW-t	MT20	4.0	9.0		
Q	BMVW-t	MT20	4.0	4.0		
R	BMVW1-t	MT20	4.0	9.0		Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	GROSS REACTION	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
R	1884	0	1884	0	0	5-8	5-8	5-8	5-8
L	1884	0	1884	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1330	886 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0
L	1330	886 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.61 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE	FACTORED			MEMB.	MAX. FACTORED	
	(LBS)	VERT. LOAD	LC1 MAX			FORCE	MAX
		(PLF)	CSI (LC)			(LBS)	CSI (LC)
FR-TO		FROM TO		MAX. UNBRAC	FR-TO		
				LENGTH			
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	C-Q	0 / 74
B-C	0 / 17	-91.8	-91.8	0.20 (1)	10.00	Q-D	0 / 133
C-D	-2469 / 0	-91.8	-91.8	0.30 (1)	4.12	D-P	0 / 933
D-E	-2893 / 0	-91.8	-91.8	0.54 (1)	3.61	P-E	-534 / 0
E-F	-2891 / 0	-91.8	-91.8	0.53 (1)	3.61	E-N	-2 / 0
F-G	-2891 / 0	-91.8	-91.8	0.53 (1)	3.61	N-G	-533 / 0
G-H	-2891 / 0	-91.8	-91.8	0.53 (1)	3.61	H-H	0 / 931
H-I	-2469 / 0	-91.8	-91.8	0.30 (1)	4.12	M-I	0 / 134
I-J	0 / 17	-91.8	-91.8	0.20 (1)	10.00	M-I	0 / 74
J-K	0 / 28	-91.8	-91.8	0.12 (1)	10.00	R-C	-2668 / 0
R-B	-2669 / 0	0.0	0.0	0.03 (1)	7.81	I-L	-2667 / 0
L-J	-2669 / 0	0.0	0.0	0.03 (1)	7.81		
R-Q	0 / 2167	-18.5	-18.5	0.49 (1)	10.00		
Q-P	0 / 2194	-18.5	-18.5	0.48 (1)	10.00		
P-O	0 / 2893	-18.5	-18.5	0.53 (1)	10.00		
O-N	0 / 2893	-18.5	-18.5	0.53 (1)	10.00		
N-M	0 / 2194	-18.5	-18.5	0.49 (1)	10.00		
M-L	0 / 2168	-18.5	-18.5	0.49 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.5	PSF
DL = 6.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCSC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.06")
CALCULATED VERT. DEFL.(LL) = $L/939$ (0.15")
ALLOWABLE DEFL.(TL) = $L/360$ (1.06")
CALCULATED VERT. DEFL.(TL) = $L/939$ (0.29")

CSI: TC=0.54/1.00 (D-E:1), BC=0.53/1.00 (N-P:1), WB=0.74/1.00 (I-L:1), SS=0.23/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1667 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (C) (INPUT = 0.90)

JSI METAL= 0.94 (O) (INPUT = 1.00)

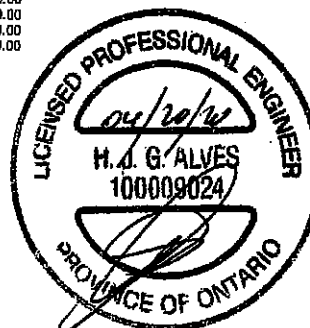

Structural component only
DWG# T-2006489

JOB NAME 408165	TRUSS NAME T21Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington


Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 09:44:21 2020 Page 2
 ID:Ovhky48Q0cPQc Y353NoTWzlcKc-a?bP6r0cB7sYb0fRD862DIHvKByE?sGDUBVwOzPlZO

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
AA	17-4	-459	-459	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


- 1) C1: A SLITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

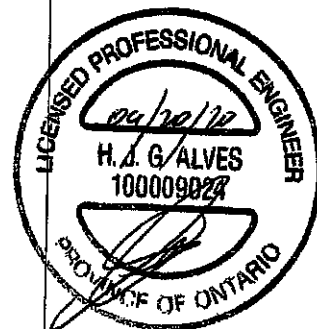

Structural component only
 DWG# T-2006488

7/2

JOB NAME 408165	TRUSS NAME T23	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Pool Truss, Burlington				Version 8.310.9 Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:44:22 2020 Page 1	
ID:1ebEM4Ce92xn94Zv7jkFPizmBR3-GBMokB1Eyr_ODAEv7xLbRGV_f9yX8PR8K2SgZPZIN				31-11-0 31-2-8	
1-3-8 01 1-3-8 5-0-8 5-0-8 4-10-0 9-10-8 6-1-0 15-11-8 6-1-0 22-0-8 4-10-0 26-10-8 5-0-8 1-3-8				Scale = 1:52.8	

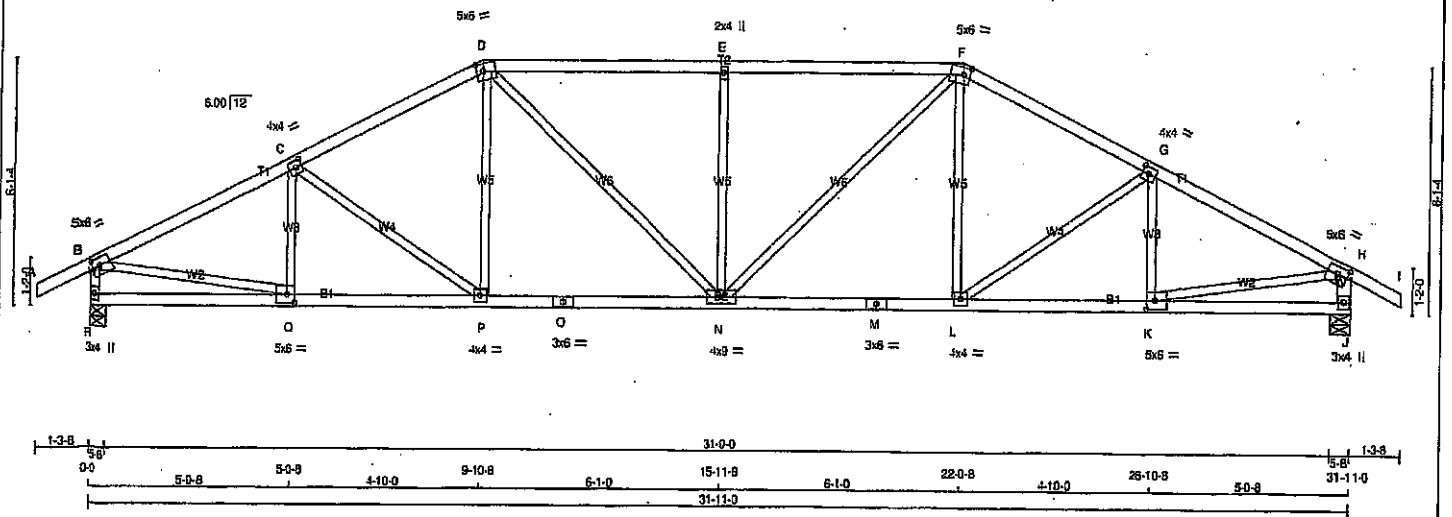

TOTAL WEIGHT = 129 lb [M/F]

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
E - F	2x4	DRY No.2	SPF
F - I	2x4	DRY No.2	SPF
I - J	2x4	DRY No.2	SPF
J - K	2x4	DRY No.2	SPF
K - L	2x4	DRY No.2	SPF
L - M	2x4	DRY No.2	SPF
M - J	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (tables in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-1	MT20	5.0	8.0	2.25	2.75
C TMVW-1	MT20	4.0	4.0	2.00	1.75
D TMVW-m	MT20	5.0	8.0	2.25	2.00
E TMVW-w	MT20	2.0	4.0		
F TMVW-m	MT20	5.0	8.0	2.25	2.00
G TMVW-1	MT20	4.0	4.0	2.00	1.75
H TMVW-1	MT20	5.0	8.0	2.25	2.75
J BMV1-p	MT20	3.0	4.0		
K BMVW-1	MT20	5.0	8.0	2.50	2.50
L BMVW-1	MT20	4.0	4.0		
M BS-1	MT20	3.0	8.0		
N BMVW-1	MT20	4.0	9.0		
O BS-1	MT20	3.0	8.0		
P BMVW-1	MT20	4.0	4.0		
Q BMVW-1	MT20	5.0	8.0	2.50	2.50
R BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	1884	1884	0	0
R 1884	0	1884	0	0
J 1884	0	1884	0	0

UNFACTORED REACTIONS

	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1330	886 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0
J	1330	886 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.82 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 28	-91.8 -91.8	0.12 (1)	10.00	Q-C	-301 / 0	0.07 (1)
B-C	-2538 / 0	-91.8 -91.8	0.37 (1)	4.02	C-P	-284 / 0	0.18 (1)
C-D	-2342 / 0	-91.8 -91.8	0.36 (1)	4.17	P-D	0 / 257	0.06 (1)
D-E	-2458 / 0	-91.8 -91.8	0.54 (1)	3.82	D-N	0 / 575	0.13 (1)
E-F	-2458 / 0	-91.8 -91.8	0.54 (1)	3.82	N-E	-685 / 0	0.40 (1)
F-G	-2342 / 0	-91.8 -91.8	0.35 (1)	4.17	N-F	0 / 575	0.13 (1)
G-H	-2538 / 0	-91.8 -91.8	0.37 (1)	4.02	L-F	0 / 257	0.06 (1)
H-I	0 / 28	-91.8 -91.8	0.12 (1)	10.00	L-G	-284 / 0	0.18 (1)
R-B	-1841 / 0	0.0 0.0	0.19 (1)	8.17	K-G	-301 / 0	0.07 (1)
J-H	-1841 / 0	0.0 0.0	0.19 (1)	8.17	B-Q	0 / 2323	0.52 (1)
					K-H	0 / 2323	0.52 (1)
R-Q	0 / 0	-18.5 -18.5	0.10 (4)	10.00			
Q-P	0 / 2260	-18.5 -18.5	0.43 (1)	10.00			
P-O	0 / 2077	-18.5 -18.5	0.40 (1)	10.00			
O-N	0 / 2077	-18.5 -18.5	0.40 (1)	10.00			
N-M	0 / 2077	-18.5 -18.5	0.40 (1)	10.00			
M-L	0 / 2077	-18.5 -18.5	0.40 (1)	10.00			
L-K	0 / 2250	-18.5 -18.5	0.43 (1)	10.00			
K-J	0 / 0	-18.5 -18.5	0.10 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.06")
CALCULATED VERT. DEFL. (LL) = L/999 (0.13")
ALLOWABLE DEFL. (TL) = L/360 (1.06")
CALCULATED VERT. DEFL. (TL) = L/999 (0.24")

CS1: TC=0.54/1.00 (D-E:1), BC=0.43/1.00 (K-L:1), WB=0.52/1.00 (H-K:1), SS=0.27/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.67 (B) (INPUT = 1.00)

Structural component only
DWG# T-2006490

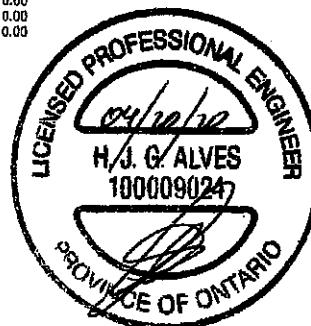

JOB NAME 408165	TRUSS NAME T24	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Road Truss, Burlington				Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Fri Apr 17 08:44:22 2020 Page 1	
				ID:1ebEM4Ce92xn94Zv7jKFPizmBR3-GBMoKB1EYR_ODAEv?xILbRGVp16yX?PR8K2SgZP1ZN	
Scale = 1:52.8					

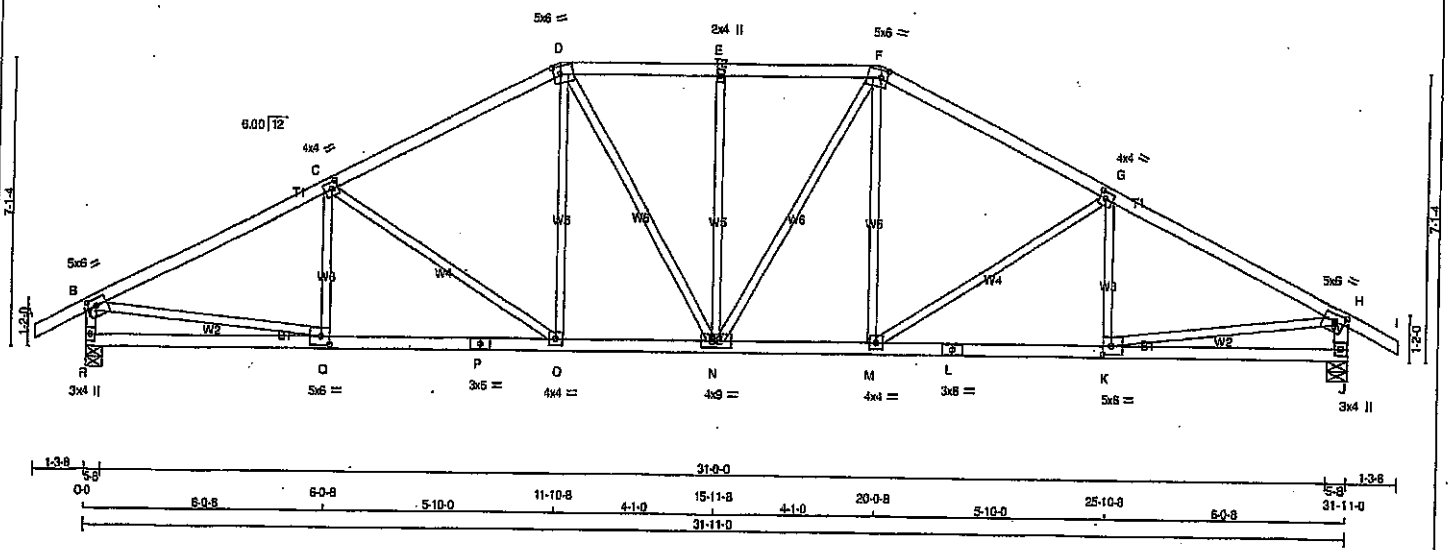

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
I - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
R - P	2x4	DRY	No.2	SPF
P - L	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (note is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	5.0	6.0	2.00	2.75
C	TMVW-1	MT20	4.0	4.0	2.00	1.75
D	TTVW-m	MT20	5.0	6.0	2.25	2.00
E	TMVW-w	MT20	2.0	4.0		
F	TTVW-m	MT20	5.0	6.0	2.25	2.00
G	TMVW-1	MT20	4.0	4.0	2.00	1.75
H	TMVW-1	MT20	5.0	6.0	2.00	2.75
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-1	MT20	5.0	6.0	2.50	2.50
L	BS-1	MT20	3.0	6.0		
M	BMVW-1	MT20	4.0	4.0		
N	BMVW-1	MT20	4.0	4.0		
O	BMVW-1	MT20	4.0	4.0		
P	BS-1	MT20	3.0	6.0		
Q	BMVW-1	MT20	5.0	6.0	2.50	2.50
R	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED			INPUT	REQD
GROSS REACTION		GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
R	1884	0	1884	0	0	5-8
J	1884	0	1884	0	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1330	888 / 0	0 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0
J	1330	888 / 0	0 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.79 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	Q-C	-212 / 29	0.06 (1)
B-C	-2579 / 0	-91.8	-91.8 0.55 (1)	3.79	C-D	-480 / 0	0.46 (1)
C-D	-2188 / 0	-91.8	-91.8 0.49 (1)	4.11	D-E	0 / 362	0.08 (1)
D-E	-2088 / 0	-91.8	-91.8 0.24 (1)	4.49	E-F	0 / 293	0.07 (1)
E-F	-2088 / 0	-91.8	-91.8 0.24 (1)	4.49	F-G	-451 / 0	0.39 (1)
F-G	-2188 / 0	-91.8	-91.8 0.49 (1)	4.11	G-H	0 / 296	0.07 (1)
G-H	-2579 / 0	-91.8	-91.8 0.55 (1)	3.79	H-I	0 / 362	0.08 (1)
H-I	0 / 28	-91.8	-91.8 0.12 (1)	10.00	I-J	-480 / 0	0.46 (1)
I-J	-1838 / 0	0.0	0.0 0.19 (1)	6.18	J-K	-212 / 29	0.06 (1)
J-K	-1838 / 0	0.0	0.0 0.19 (1)	6.18	K-L	0 / 2355	0.53 (1)
K-L	0 / 0	-18.5	-18.5 0.15 (4)	10.00	L-M	0 / 2355	0.53 (1)
L-M	0 / 2332	-18.5	-18.5 0.44 (1)	10.00	M-N	0 / 2332	0.44 (1)
M-N	0 / 2332	-18.5	-18.5 0.44 (1)	10.00	N-O	0 / 1935	0.37 (1)
N-O	0 / 1935	-18.5	-18.5 0.37 (1)	10.00	O-P	0 / 2332	0.44 (1)
O-P	0 / 2332	-18.5	-18.5 0.44 (1)	10.00	P-Q	0 / 2332	0.44 (1)
P-Q	0 / 2332	-18.5	-18.5 0.44 (1)	10.00	Q-R	0 / 2332	0.44 (1)
Q-R	0 / 2332	-18.5	-18.5 0.44 (1)	10.00	R-S	0 / 2332	0.44 (1)
R-S	0 / 2332	-18.5	-18.5 0.44 (1)	10.00	S-T	0 / 2332	0.44 (1)
S-T	0 / 2332	-18.5	-18.5 0.44 (1)	10.00	T-U	0 / 2332	0.44 (1)
T-U	0 / 2332	-18.5	-18.5 0.44 (1)	10.00	U-V	0 / 2332	0.44 (1)
U-V	0 / 2332	-18.5	-18.5 0.44 (1)	10.00	V-W	0 / 2332	0.44 (1)
V-W	0 / 2332	-18.5	-18.5 0.44 (1)	10.00	W-X	0 / 2332	0.44 (1)
W-X	0 / 2332	-18.5	-18.5 0.44 (1)	10.00	X-Y	0 / 2332	0.44 (1)
X-Y	0 / 2332	-18.5	-18.5 0.44 (1)	10.00	Y-Z	0 / 2332	0.44 (1)
Y-Z	0 / 2332	-18.5	-18.5 0.44 (1)	10.00	Z-A	0 / 2332	0.44 (1)
Z-A	0 / 2332	-18.5	-18.5 0.44 (1)	10.00	A-B	0 / 2332	0.44 (1)

TOTAL WEIGHT = 136 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 085-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.08")
CALCULATED VERT. DEFL. (LL) = L/999 (0.12")
ALLOWABLE DEFL. (TL) = L/360 (1.08")
CALCULATED VERT. DEFL. (TL) = L/999 (0.21")

CSI: TC=0.55/1.00 (G-H:1), BC=0.44/1.00 (K-M:1), WB=0.53/1.00 (H-K:1), SSI=0.24/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	354	1687
618	785	1987
856		

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.85 (H) (INPUT = 0.90)
JSI METAL= 0.74 (F) (INPUT = 1.00)

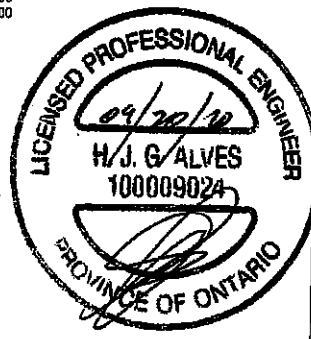

Structural component only
DWG# T-2006491

JOB NAME 408165	TRUSS NAME T25	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2018 MTak Industries, Inc. Fri Apr 17 08:44:22 2020 Page 1
 ID:1ebEM4Ce92xn94Zv?kFPizmBR3-GSMoKB1Eyr_ODAEV?xLbRGRCjePyXzPR8K2SgzPizN
 1-3-8 0-0 7-0-8 7-0-8 6-10-0 13-10-8 4-2-0 18-0-8 6-10-0 24-10-8 7-0-8 31-1-0 33-2-8
 Scale = 1:53.3

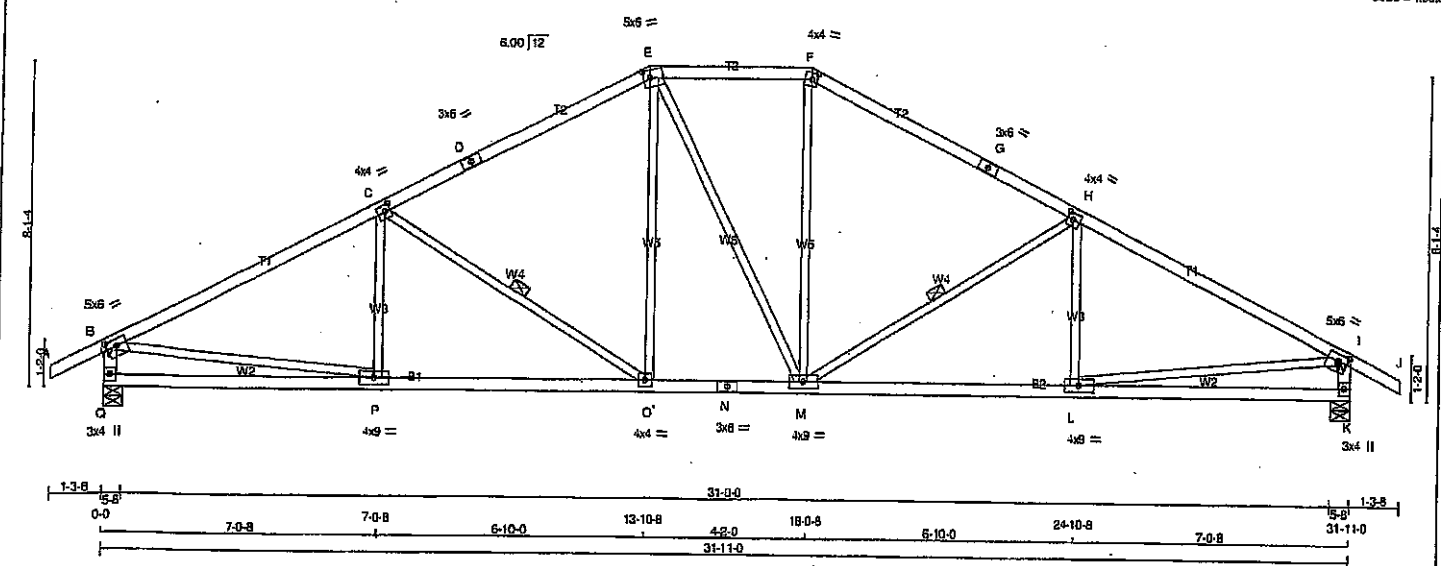

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
J - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	5.0	6.0	2.00	2.75
C	TMVW-1	MT20	4.0	4.0	2.00	1.75
D	TS-1	MT20	3.0	6.0		
E	TTWW-m	MT20	5.0	6.0	2.25	2.00
F	TTWW-m	MT20	4.0	4.0	2.00	1.75
G	TS-1	MT20	3.0	6.0		
H	TMVW-1	MT20	4.0	4.0	2.00	1.75
I	TMVW-1	MT20	5.0	6.0	2.00	2.75
K	BMV1-p	MT20	3.0	4.0		
L	BMVW-1	MT20	4.0	9.0		
M	BMVW-1	MT20	4.0	9.0		
N	BS-1	MT20	3.0	6.0		
O	BMVW-1	MT20	4.0	4.0		
P	BMVW-1	MT20	4.0	9.0		
Q	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
Q	1884	0	1884	0	5-8
K	1884	0	1884	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
Q	1330	886	0	0	0	0	444	0
K	1330	886	0	0	0	0	444	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	0 / 28	P-C	-140 / 71
B-C	-2587 / 0	C-O	-691 / 0
C-D	-2013 / 0	O-E	0 / 458
D-E	-2013 / 0	E-M	0 / 2
E-F	-1775 / 0	M-F	0 / 450
F-G	-2013 / 0	M-H	-690 / 0
G-H	-2013 / 0	H-L	-142 / 70
H-I	-2587 / 0	L-P	0 / 2362
I-J	0 / 28	P-L	0 / 2361
J-K	-1830 / 0		
K-L	-1830 / 0		
Q-P	0 / 0		
P-O	0 / 2344		
O-N	0 / 1774		
N-M	0 / 1774		
M-L	0 / 2344		
L-K	0 / 0		

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.8 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-03, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.06")
 CALCULATED VERT. DEFL. (LL) = L/999 (0.12")
 ALLOWABLE DEFL. (TL) = L/360 (1.06")
 CALCULATED VERT. DEFL. (TL) = L/999 (0.24")

CSI: TC=0.78/1.00 (B-C-1), BC=0.48/1.00 (O-P-1),
 WB=0.53/1.00 (B-P-1), SS=0.28/1.00 (H-I-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP (DRY) SHEAR SECTION (PS) (PL) (PL)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1687 788 1987 1686

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JS GRIP= 0.89 (B) (INPUT = 0.90)
 (S) METAL= 0.70 (B) (INPUT = 1.00)

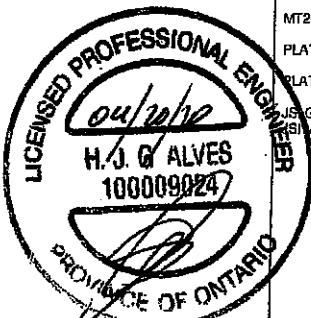


Structural component only
 DWG# T-2006492

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408165	T26	8	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Fri Apr 17 08:44:23 2020 Page 1
ID:1ebEM4Ce92xn94Zy7ikFPizmBR3-kNwAXX1ii6FtK6ZeBa7eojN7_Bh_xZgm4b_GzPizM
31-11-0 33-2-8
Scale = 1:53.5

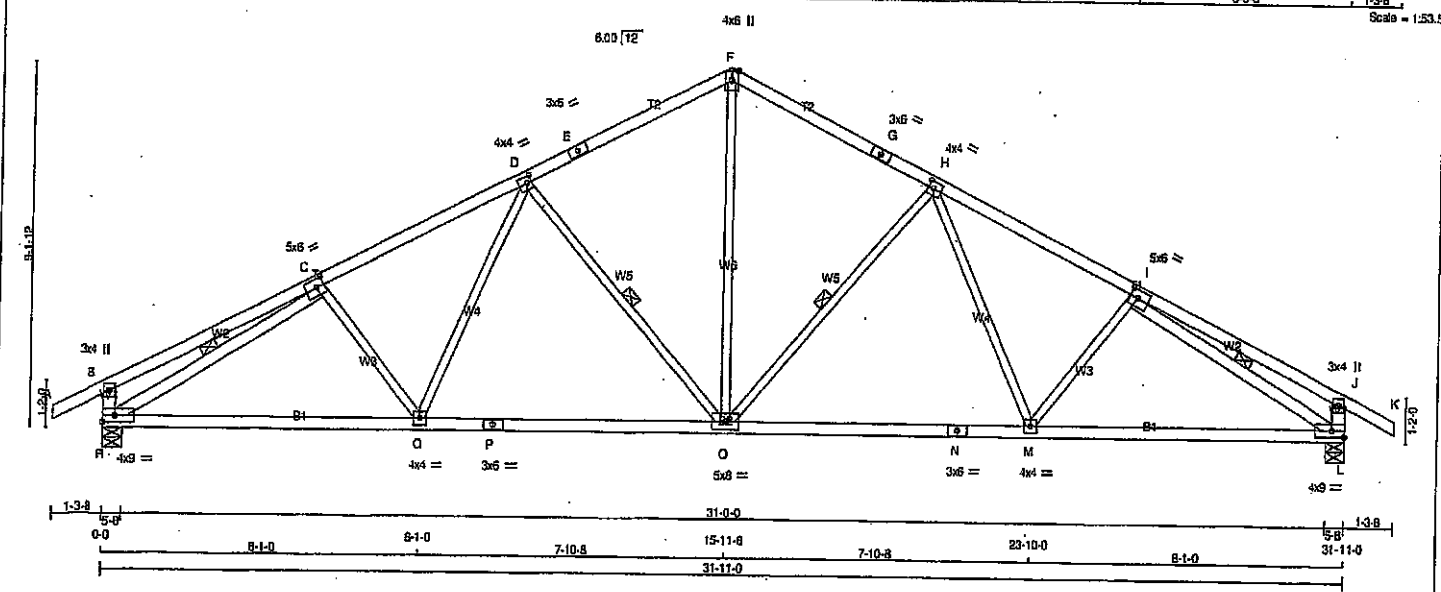

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
G - K	2x4	DRY	No.2	SPF
R - B	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
R - P	2x4	DRY	No.2	SPF
P - N	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
R - C	2x4	DRY	No.2	SPF
I - L	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMWW-1	MT20	5.0	6.0	2.50	2.50
D TMWW-1	MT20	4.0	4.0	2.00	1.50
E TS-1	MT20	3.0	6.0		
F TMV+p	MT20	4.0	6.0	Edge	
G TS-1	MT20	3.0	6.0		
H TMWW-1	MT20	4.0	4.0	2.00	1.50
I TMWW-1	MT20	5.0	6.0	2.50	2.50
J TMV+p	MT20	3.0	4.0		
L BMWW-1	MT20	4.0	9.0	Edge	
M BMWW-1	MT20	4.0	4.0		
N BS-1	MT20	3.0	6.0		
O BMWW-1	MT20	5.0	6.0		
P BS-1	MT20	3.0	6.0		
Q BMWW-1	MT20	4.0	4.0		
R BMWW-1	MT20	4.0	9.0	Edge	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	1884	0	1884	0
R	1884	0	1884	0
L	1884	0	1884	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX./MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1330	888 / 0	0 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0
L	1330	888 / 0	0 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.11 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF H-O, D-O, C-R, H-L

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO						FR-TO			
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	O-F	0 / 1211	0.27 (1)	0.32 (1)
B-C	0 / 20	-91.8	-91.8	0.33 (1)	10.00	O-H	-701 / 0	0.32 (1)	0.32 (1)
C-D	-2428 / 0	-91.8	-91.8	0.37 (1)	4.11	H-M	0 / 312	0.07 (1)	0.07 (1)
D-E	-1808 / 0	-91.8	-91.8	0.34 (1)	4.85	M-I	-156 / 21	0.05 (1)	0.05 (1)
E-F	-1808 / 0	-91.8	-91.8	0.34 (1)	4.85	D-O	-701 / 0	0.32 (1)	0.32 (1)
F-G	-1808 / 0	-91.8	-91.8	0.34 (1)	4.85	O-D	0 / 312	0.07 (1)	0.07 (1)
G-H	-1808 / 0	-91.8	-91.8	0.34 (1)	4.85	C-Q	-156 / 21	0.05 (1)	0.05 (1)
H-I	-2428 / 0	-91.8	-91.8	0.37 (1)	4.11	R-C	-2717 / 0	0.55 (1)	0.55 (1)
I-J	0 / 20	-91.8	-91.8	0.33 (1)	10.00	I-L	-2717 / 0	0.55 (1)	0.55 (1)
J-K	0 / 28	-91.8	-91.8	0.12 (1)	10.00				
R-B	-325 / 0	0.0	0.0	0.03 (1)	7.81				
L-J	-325 / 0	0.0	0.0	0.03 (1)	7.81				
R-Q	0 / 2268	-18.5	-18.5	0.51 (1)	10.00				
O-P	0 / 2051	-18.5	-18.5	0.48 (1)	10.00				
P-O	0 / 2051	-18.5	-18.5	0.48 (1)	10.00				
O-N	0 / 2051	-18.5	-18.5	0.48 (1)	10.00				
N-M	0 / 2051	-18.5	-18.5	0.48 (1)	10.00				
M-L	0 / 2268	-18.5	-18.5	0.51 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL	6.0	PSF
BOT CH.	LL = 0.0	PSF
DL	7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPOC 2011, TPOC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.06")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.37/1.00 (H-I), BC=0.51/1.00 (L-M), WB=0.55/1.00 (H-L), SS=0.20/1.00 (I-J)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.85 (I) (INPUT = 0.90)

JSI METAL=0.67 (I) (INPUT = 1.00)

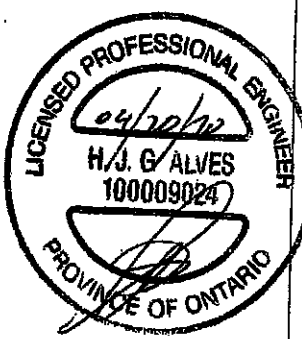

Structural component only
DWG# T-2006493


JOB NAME 408165	TRUSS NAME T32	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Fri Apr 17 06:44:24 2020 Page 1

ID:Ovhty48Q0cPQc_Y353NoTWzldKo-DaLUI2VU2E6SUNIT7MpgsLvOXHaQXzivRp9XjzPIZL

Scale = 1:23.7

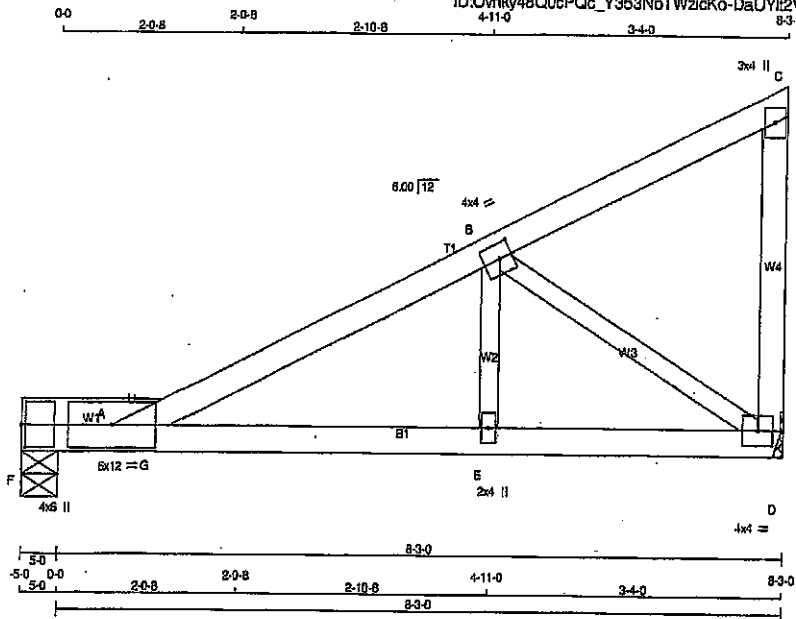

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
F - A	2x4	DRY	No.2

ALL WEBS 2x3 DRY
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	BMW-I	MT20	6.0	12.0		
B	TMVW-I	MT20	4.0	4.0	2.00	1.75
C	TMVW-I	MT20	3.0	4.0		
D	BMVW-I	MT20	4.0	4.0		
E	BMVW-I	MT20	2.0	4.0		
F	BMVW-I	MT20	4.0	6.0	3.00	0.50

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
D	478	478	0	0
F	478	478	5-0	5-0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	338	222 / 0	0 / 0	0 / 0	0 / 0	0 / 0	116 / 0	0 / 0
F	338	222 / 0	0 / 0	0 / 0	0 / 0	0 / 0	116 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)	MAX. FACTORED VERT. LOAD (LC4)	MAX. FACTORED VERT. LOAD (LC5)	MAX. FACTORED VERT. LOAD (LC6)	MAX. FACTORED VERT. LOAD (LC7)	MAX. FACTORED VERT. LOAD (LC8)	MAX. FACTORED VERT. LOAD (LC9)	MAX. FACTORED VERT. LOAD (LC10)
FR-TO												
A-H	-831 / 0	-91.8	-91.8	0.21 (1)	6.25	0 / 195	0.04 (1)					
H-B	-827 / 0	-91.8	-91.8	0.29 (1)	6.25	0 / 195	0.04 (1)					
B-C	-27 / 0	-91.8	-91.8	0.21 (1)	6.25	0 / 195	0.04 (1)					
D-E	-93 / 0	0.0	0.0	0.02 (1)	7.81	0 / 195	0.04 (1)					
F-A	0 / 0	-110.3	-110.3	0.25 (1)	10.00	0 / 195	0.04 (1)					
A-G	0 / 602	-18.5	-18.5	0.69 (1)	10.00	0 / 195	0.04 (1)					
G-E	0 / 602	-18.5	-18.5	0.47 (1)	10.00	0 / 195	0.04 (1)					
E-D	0 / 602	-18.5	-18.5	0.23 (1)	10.00	0 / 195	0.04 (1)					

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
DL = 6.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD = 39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.29")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.29")
CALCULATED VERT. DEFL.(TL) = L/708 (0.15")

CSI: TC=0.29/1.00 (B-H:1), BC=0.69/1.00 (A-G:1), WB=0.18/1.00 (B-D:1), SS=0.30/1.00 (A-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PS)	SECTION (PL)
MT20	618	354
MT20	1657	788
MT20	1987	1656

PLATE PLACEMENT TOL = 0.250 Inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.65 (D) (INPUT = 0.90)
JSI METAL= 0.26 (A) (INPUT = 1.00)



Structural component only
DWG# T-2006494

JOB NAME 408165	TRUSS NAME T33S	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington ID:Ovhky48Q0cPQc_Y353No1TWzicKa-hm2wyD37EMMz4eyUg3D2D3u2DxguSubs85Zi39zPZK Version 8.310 S Oct 29 2018 MTEK Industries, Inc. Fri Apr 17 08:44:25 2020 Page 1

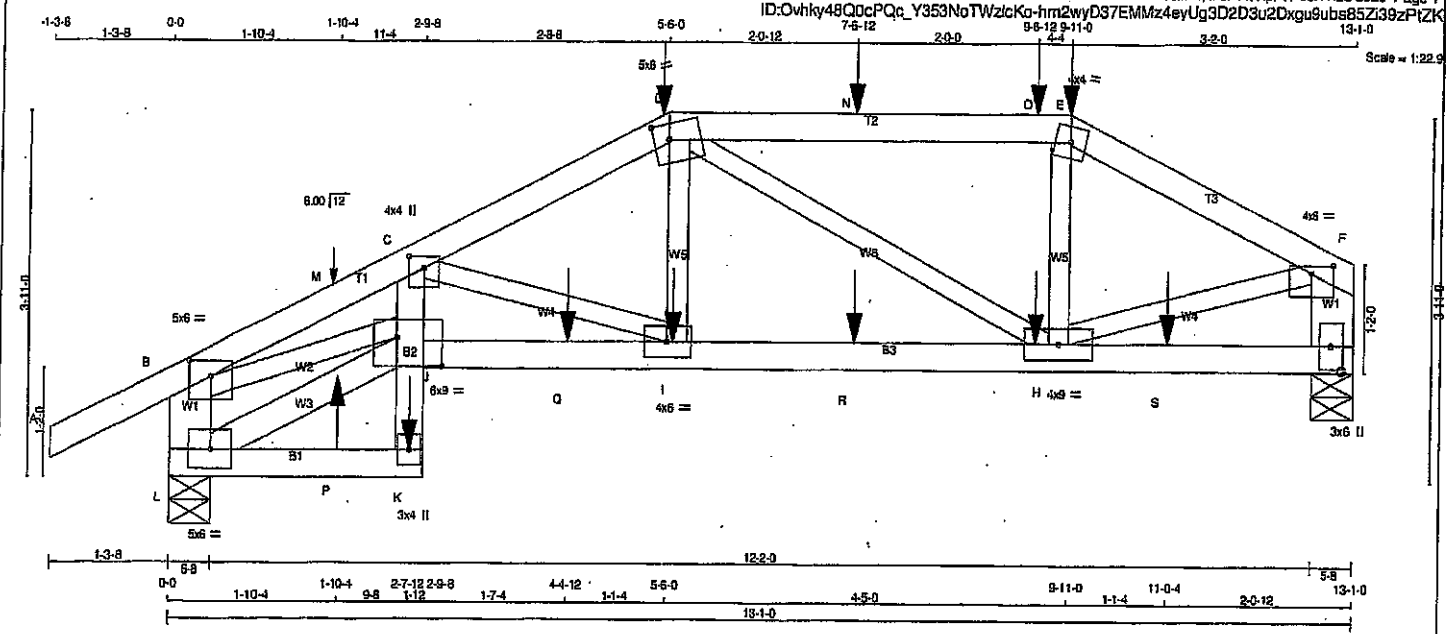

LUMBER

N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
L - B	2x6	DRY	No.2	SPF
G - F	2x6	DRY	No.2	SPF
L - K	2x4	DRY	No.2	SPF
K - C	2x4	DRY	No.2	SPF
J - G	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF

DRY, SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	6.0	2.00	3.00
C TMVW+p	MT20	4.0	4.0	1.50	2.00
D TTWW-m	MT20	5.0	6.0	2.00	2.00
E TTW-m	MT20	4.0	4.0		
F TMVW-p	MT20	4.0	6.0	1.00	3.00
G BMV1+p	MT20	3.0	6.0		
H BMVWV-I	MT20	4.0	6.0		
I BMVWV-I	MT20	4.0	6.0		
J BMVWV-I	MT20	6.0	9.0	3.75	6.00
K BMV+p	MT20	3.0	4.0		
L BMVWV-I	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	BRG	BRG	IN-SX
G	1008	0	0	1008	0	0	5-8	5-8	5-8
L	1158	0	0	1158	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS	DEAD	SOIL
G	711	480 / 0	0 / 0	0 / 0	231 / 0
L	814	560 / 0	0 / 0	0 / 0	254 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.21 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (7)

CHORDS		FACTORED		MAX		MAX		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX	MAX	MEMB.	FORCE (LBS)	MAX	MAX	CS1 (LC)	CS1 (LC)
FR-TO						FR-TO					
A-B	0 / 28	-91.8	-91.8	0.13 (1)	10.00	C-I	-939 / 0	0.20 (1)	0.20 (1)		
B-M	-2420 / 0	-91.8	-91.8	0.21 (1)	4.21	D-H	0 / 386	0.10 (1)	0.10 (1)		
M-C	-2420 / 0	-91.8	-91.8	0.21 (1)	4.21	D-H	-389 / 0	0.18 (1)	0.18 (1)		
C-D	-1595 / 0	-91.8	-91.8	0.18 (1)	5.02	H-E	0 / 77	0.03 (4)	0.03 (4)		
D-N	-1106 / 0	-91.8	-91.8	0.41 (1)	5.41	H-F	0 / 1141	0.28 (1)	0.28 (1)		
N-O	-1106 / 0	-91.8	-91.8	0.41 (1)	5.41	L-J	-143 / 0	0.02 (1)	0.02 (1)		
O-E	-1105 / 0	-91.8	-91.8	0.41 (1)	5.41	B-J	0 / 2178	0.54 (1)	0.54 (1)		
E-F	-1238 / 0	-91.8	-91.8	0.20 (1)	5.51						
L-B	-1077 / 0	0.0	0.0	0.08 (1)	7.81						
G-F	-992 / 0	0.0	0.0	0.07 (1)	7.81						
L-P	0 / 131	-18.5	-18.5	0.05 (4)	10.00						
P-K	0 / 131	-18.5	-18.5	0.05 (4)	10.00						
K-J	0 / 203	0.0	0.0	0.27 (1)	10.00						
J-C	0 / 422	0.0	0.0	0.30 (1)	10.00						
J-Q	0 / 2314	-18.5	-18.5	0.43 (1)	10.00						
Q-I	0 / 2314	-18.5	-18.5	0.43 (1)	10.00						
I-R	0 / 1442	-18.5	-18.5	0.30 (1)	10.00						
R-H	0 / 1442	-18.5	-18.5	0.30 (1)	10.00						
H-S	0 / 0	-18.5	-18.5	0.07 (4)	10.00						
S-G	0 / 0	-18.5	-18.5	0.07 (4)	10.00						

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
D	5-8-0	-178	-178	---	FRONT	VERT	TOTAL	---	C1
E	9-11-0	-134	-134	---	FRONT	VERT	TOTAL	---	C1
H	9-8-12	-7	-7	---	FRONT	VERT	TOTAL	---	C1
I	5-6-12	-7	-7	---	FRONT	VERT	TOTAL	---	C1
K	2-7-12	-184	-184	---	FRONT	VERT	TOTAL	---	C1
M	1-10-4	1	1	104	FRONT	VERT	TOTAL	---	C1
N	7-8-12	-17	-17	---	FRONT	VERT	TOTAL	---	C1
O	9-6-12	-47	-47	---	FRONT	VERT	TOTAL	---	C1
P	1-10-4	7	7	12	FRONT	VERT	TOTAL	---	C1
Q	4-4-12	-3	-3	---	FRONT	VERT	TOTAL	---	C1
R	7-6-12	-7	-7	---	FRONT	VERT	TOTAL	---	C1
S	11-0-4	-3	-3	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
DL	=	6.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN PLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.44")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/380 (0.44")
CALCULATED VERT. DEFL.(TL) = L/999 (0.10")

CS1: TC=0.41/1.00 (D-E:1), BC=0.43/1.00 (I-J:1), WS=0.54/1.00 (B-J:1), SS=0.22/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1867
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (J) (INPUT = 0.90)
JSI METAL= 0.49 (B) (INPUT = 1.00)

Structural component only
DWG# T-2006495

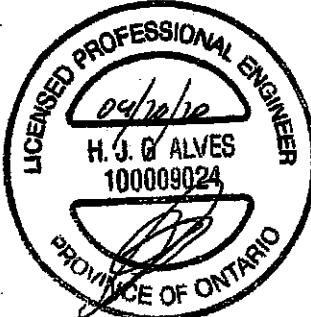


JOB NAME 408165	TRUSS NAME J21	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 2019 Mitek Industries, Inc. Fri Apr 17 08:44:08 2020 Page 1
ID:Ovhky48Q0cPQc_Y353NoTWzicKa-gVWVOPsSF8DOX09DB?P30Uhd04z4hKaMDyxiyozP1Zb

Scale = 1:13.1

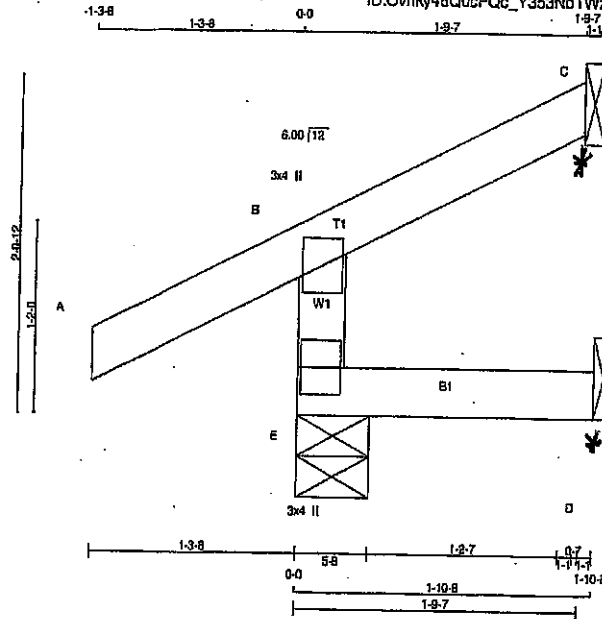

TOTAL WEIGHT = 6 X 7 = 42 lb

LUMBER

N.L.G.A. RULES	CHORDS	SIZE	DRY	LUMBER	No.2
E - B	2x4	DRY	No.2		
A - C	2x4	DRY	No.2		
E - D	2x4	DRY	No.2		

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	271	0	271	0	5-8	5-8
C	45	0	45	0	1-8	1-8
D	8	0	17	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 180 LBS FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 180 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	188	141 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0
C	31	24 / -18	0 / 0	0 / 0	0 / 0	7 / 0	0 / 0
D	7	0 / -8	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. FACTORED UNBRACED LENGTH FR-TO		MEMB. MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
				FROM	TO		
E-B	-244 / 0	0.0	0.0	0.04 (5)	7.81		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00		
B-C	-17 / 0	-91.8	-91.8	0.09 (1)	6.25		
E-D	0 / 0	-18.5	-18.5	0.04 (5)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
-PART 9 OF BCBC 2018, OBC 2012, ABC 2019
-PART 9 OF OBC 2012 (2019 AMENDMENT)
-CSA 086-09, CSA 086-14
-TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5),
WB=0.00/1.00 (A-B:0), SS=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (5) (INPUT = 0.99)
JSI METAL= 0.07 (5) (INPUT = 1.00)

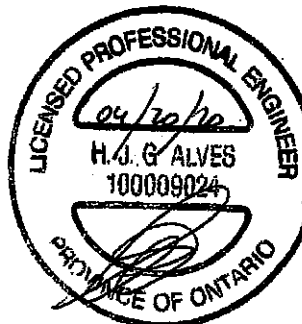


Structural component only
DWG# T-2006477

JOB NAME 408165	TRUSS NAME J22	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

ID:Ovhky48Q0cPQc_Y353NoTWzlcKo-9h4t6s50RLE9AkPhixIzhDM8UJeCn2VSchsV4zP1Za
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:44:09 2020 Page 1

Scale = 1:16.2

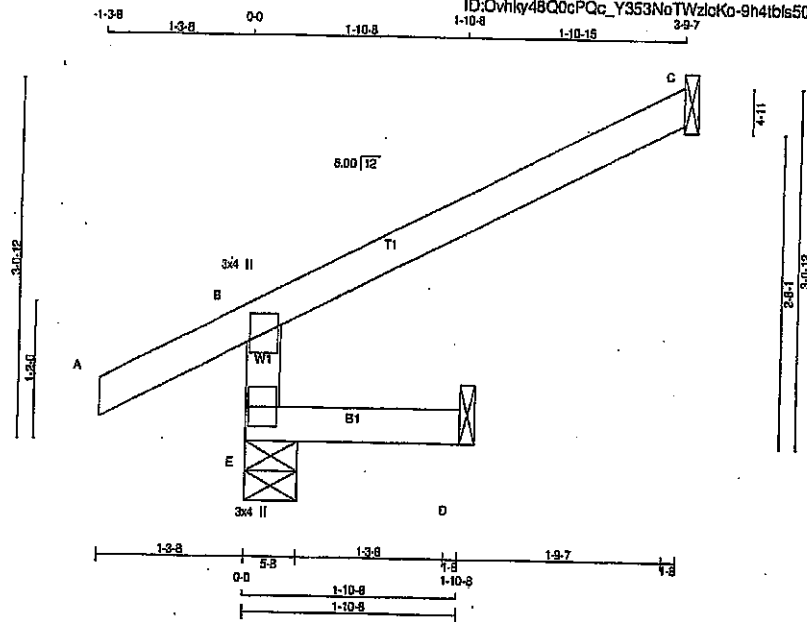

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
E - B	2x4	DRY No.2
A - C	2x4	DRY No.2
E - D	2x4	DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	361	0	361	0	5-8	5-8
C	130	0	130	0	1-8	1-8
D	16	0	17	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	COMBINED	MAX/MIN. COMPONENT REACTIONS				WIND	DEAD	SOIL
		1ST CASE	SNOW	LIVE	PERM. LIVE			
E	250	180 / 0	0 / 0	0 / 0	0 / 0	60 / 0	0 / 0	0 / 0
C	90	73 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0	0 / 0
D	12	0 / 0	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	WEBS		MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)
				MAX. VERT. LOAD (LC)	MAX. UNBRACED LENGTH		
FR-TO							
E-B		-342 / 0	0.0	0.0	0.01 (4)	7.81	
A-B		0 / 28	-91.8	-91.8	0.13 (5)	10.00	
B-C		-19 / 0	-91.8	-91.8	0.22 (1)	6.25	
E-D		0 / 0	-18.5	-18.5	0.02 (4)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 10 = 29 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OSC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIG 2011, TPIG 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19')
CALCULATED VERT. DEFL.(LL) = L/999 (0.00')
ALLOWABLE DEFL.(TL) = L/360 (0.19')
CALCULATED VERT. DEFL.(TL) = L/999 (0.00')

CSI: TC=0.22/1.00 (B-C-1), BC=0.02/1.00 (D-E-4), WB=0.00/1.00 (n/a-3), SSI=0.15/1.00 (B-C-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1967 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

ISI GRIP = 0.14 (E) (INPUT = 0.90)
ISI METAL = 0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006478

JOB NAME 408165	TRUSS NAME J23	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:44:10 2020 Page 1 ID:Ovhky48Q0cPQc_Y353NoTWzlcKo-dteFo4tjnT5nKJclQSX6vmZVud_9EiehgQP1WzPZZ			

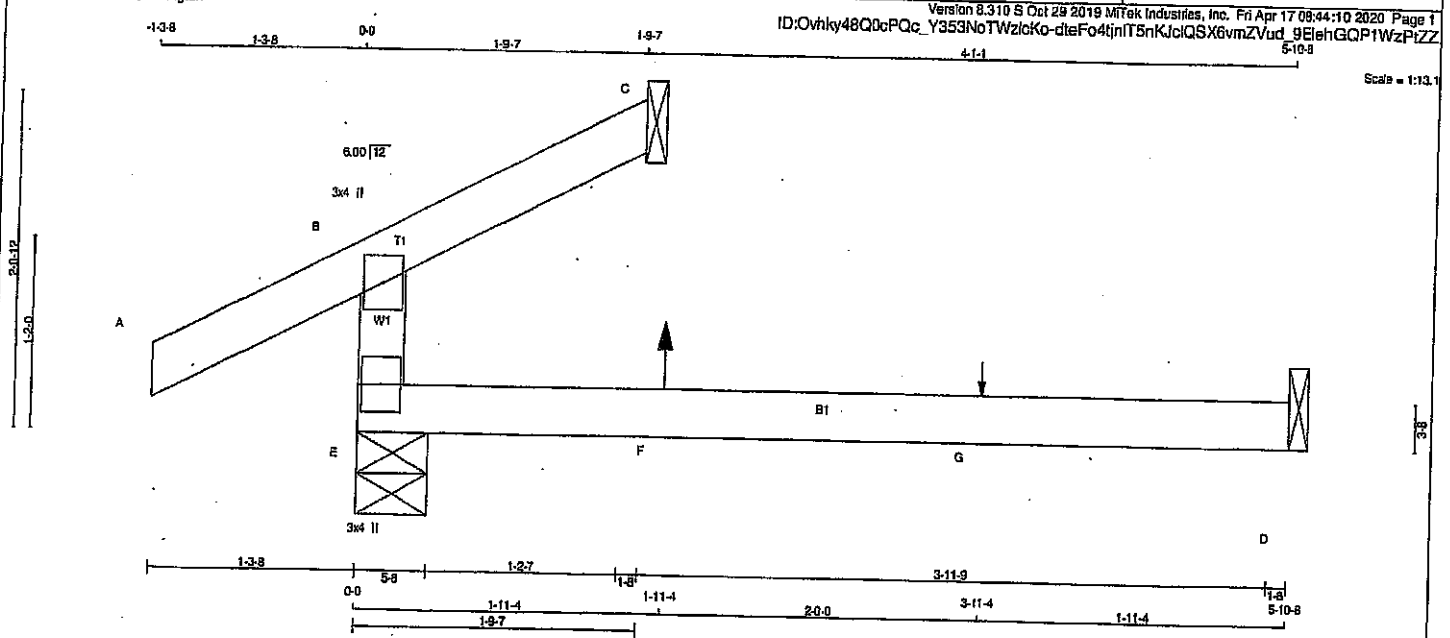

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
E	284	0	284	0	0	5-8	5-8	
C	63	0	63	0	0	1-8	1-8	
D	44	0	52	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	200	137.0	0.0	0.0	0.0	82.0	0.0
C	46	21.0	0.0	0.0	0.0	25.0	0.0
D	35	0.0	0.0	0.0	0.0	37.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 18.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (7)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO				FR-TO			
E-B	-227.0	0.0	0.0	0.11 (4)	7.81		
A-B	0.28	-91.8	-91.8	0.12 (1)	10.00		
B-C	-9.9	-91.8	-91.8	0.08 (4)	10.00		
E-F	0.0	-18.5	-18.5	0.14 (4)	10.00		
F-G	0.0	-18.5	-18.5	0.14 (4)	10.00		
G-D	0.0	-18.5	-18.5	0.14 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	HEEL
F	1-11-4	7	1	12	BACK	VERT	C1
G	3-11-4	1	1	---	BACK	VERT	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.04")

CSI: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SS=0.09/1.00 (A-B:1)

DOL LUMBER=0.99 NAIL=0.99 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)

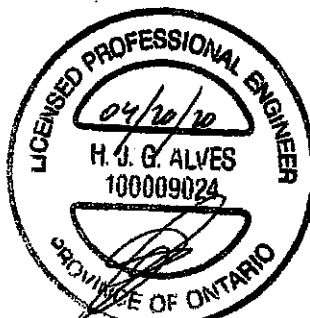

Structural component only
DWG# T-2006479

JOB NAME 408165	TRUSS NAME J24	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
Tamarack Roof Truss, Burlington						

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:44:11 2020 Page 1
ID:Ovhky48Q0cPQc_Y353NoTWzlcKo-53Cd0QuLX3byOUuos7zme6JheizJuhYowwAzZzzPzY

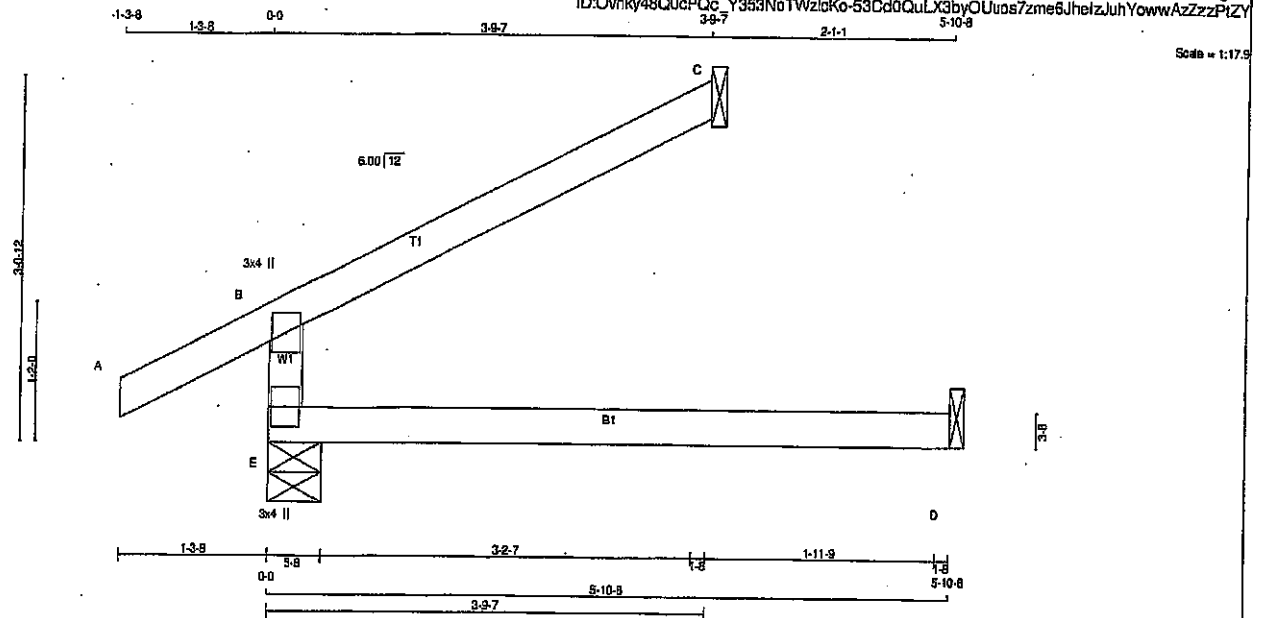

TOTAL WEIGHT = 2 X 14 = 28 lb

LUMBER

N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

	FACTORED		MAXIMUM FACTORED			INPUT	REQD
	GROSS REACTION		GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	405	0	405	0	0	5-8	5-8
C	130	0	130	0	0	1-8	1-8
D	45	0	50	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	285	190 / 0	0 / 0	0 / 0	0 / 0	86 / 0	0 / 0
C	90	73 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB. FR-TO	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO					
E-B	-342 / 0	0.0	0.0	0.13 (4)	7.81		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00		
B-C	-19 / 0	-91.8	-91.8	0.22 (1)	6.25		
E-D	0 / 0	-18.5	-18.5	0.13 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 5.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CSI: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY) SHEAR	SECTION
(PSI)	(PLI)
MAX MIN	MAX MIN
MT20	818 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (B) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)

Structural component only
DWG# T-2006480

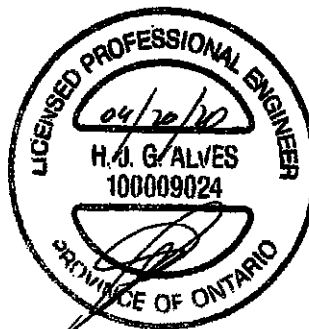


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408165	J25	11	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 09:44:12 2020 Page 1
ID:Ovhky48Q0cPQc_Y353NoTWzclKQ-ZGm0DmvzIMj0eT_QqU78KmShiYd7ox8avW6PzPlZX
5-10-8

Scale = 1/22.9

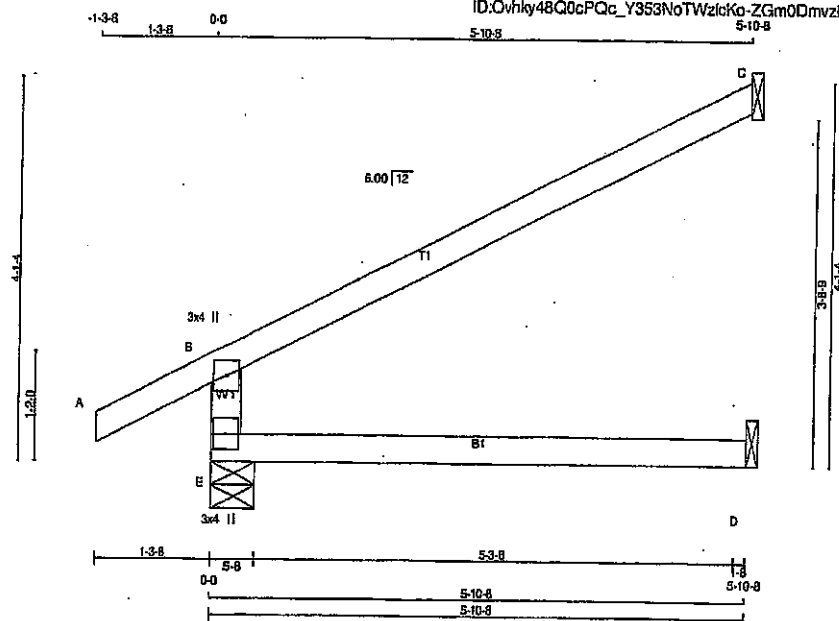

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED		MAXIMUM FACTORED			INPUT	REQD
	GROSS REACTION	GROSS REACTION	GROSS REACTION	UP/LIFT	BRG	BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	
E	525	0	525	0	5-8	5-8	
C	202	0	202	0	1-8	1-8	
D	45	0	50	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE	MAX/MIN. COMPONENT REACTIONS		LIVE	PERM. LIVE	WIND	DEAD	SOIL
	COMBINED	SNOW					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	369	257.0	0.0	0.0	0.0	111.0	0.0
C	139	113.0	0.0	0.0	0.0	28.0	0.0
D	36	0.0	0.0	0.0	0.0	36.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED		MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
			VERT. LOAD	LC1					
FR-TO			FROM	TO					
E-B		-481.0	0.0	0.0	0.13 (4)	7.81			
A-B		0.28	-91.8	-91.8	0.12 (1)	10.00			
B-C		-30.0	-91.8	-91.8	0.54 (1)	6.25			
E-D		0.0	-18.5	-18.5	0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(85% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.19 (E) (INPUT = 0.90)

JSI METAL= 0.13 (B) (INPUT = 1.00)

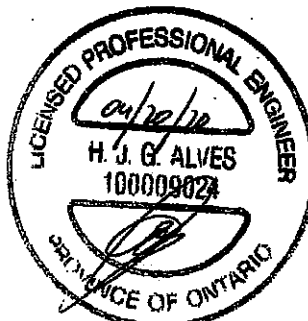

Structural component only
DWG# T-2006481

JOB NAME 408165	TRUSS NAME J31	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

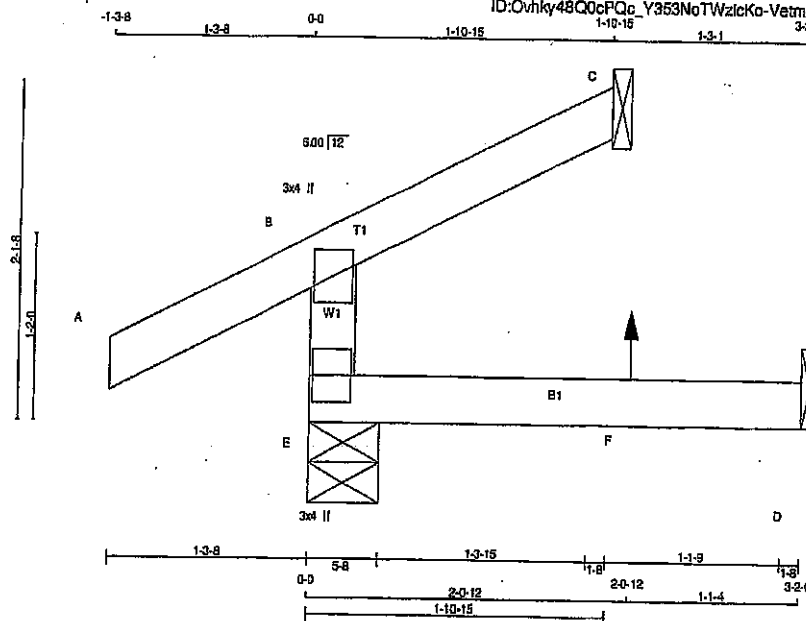

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
E - D	2x4 DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
E BMV1+p	MT20	3.0	4.0		

19204615967690640

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	DOWN	UPLIFT	IN-SX
E	264	0	0	5-8
C	68	0	0	1-8
D	21	0	0	1-8

SEE MITEK STANDARD DETAIL B97791 H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	185	128 / 0	0 / 0	0 / 0	0 / 0	0 / 0	57 / 0	0 / 0
C	46	37 / 0	0 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
							20 / 0	0 / 0

HORIZONTAL REACTIONS

6205	0.31493824889102080	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0
------	---------------------	-------	-------	-------	-------	-------

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (8)

CHORDS

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LCT (LBS)	MAX. FACTORED CS1 (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LBS)
FR-TO								
E-B	-234 / 0	0.0	0.0	0.03 (4)	7.81			
A-B	0 / 28	-91.8	-91.8	0.13 (5)	10.00			
B-C	-10 / 0	-91.8	-91.8	0.05 (1)	10.00			
E-F	0 / 0	-18.5	-18.5	0.04 (4)	10.00			
F-D	0 / 0	-18.5	-18.5	0.04 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LCT	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	2-0-12	7	1	12	FRONT	VERT	TOTAL		CI

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN.

TOTAL WEIGHT = 2 X 9 = 17 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=		39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CS1: TC=0.13/1.00 (A-B-5), BC=0.04/1.00 (D-E-4), WB=0.00/1.00 (n/a.0), SS1=0.10/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PL)
	MAX MIN	MAX MIN
MT20	618 354	1667 789 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006482

Version 8.310 © Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:44:15 2020 Page 1
ID:Ovnky48Q0cPQc_Y353NaTWzlcKc-zrR8soxrbH50i5BZ5z1ipT0hVfMqUXNqY8AkzPzI




Structural component only
DWG# T-2006483



JOB NAME 408165	TRUSS NAME J33	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Floor Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:44:16 2020 Page 1
 ID:Ovhtky48Q0cPQc_Y353NoTWzicKo-R1?W38yUMbDFVfmlgZxLA0YzJgdZxnX3CkFazPizT

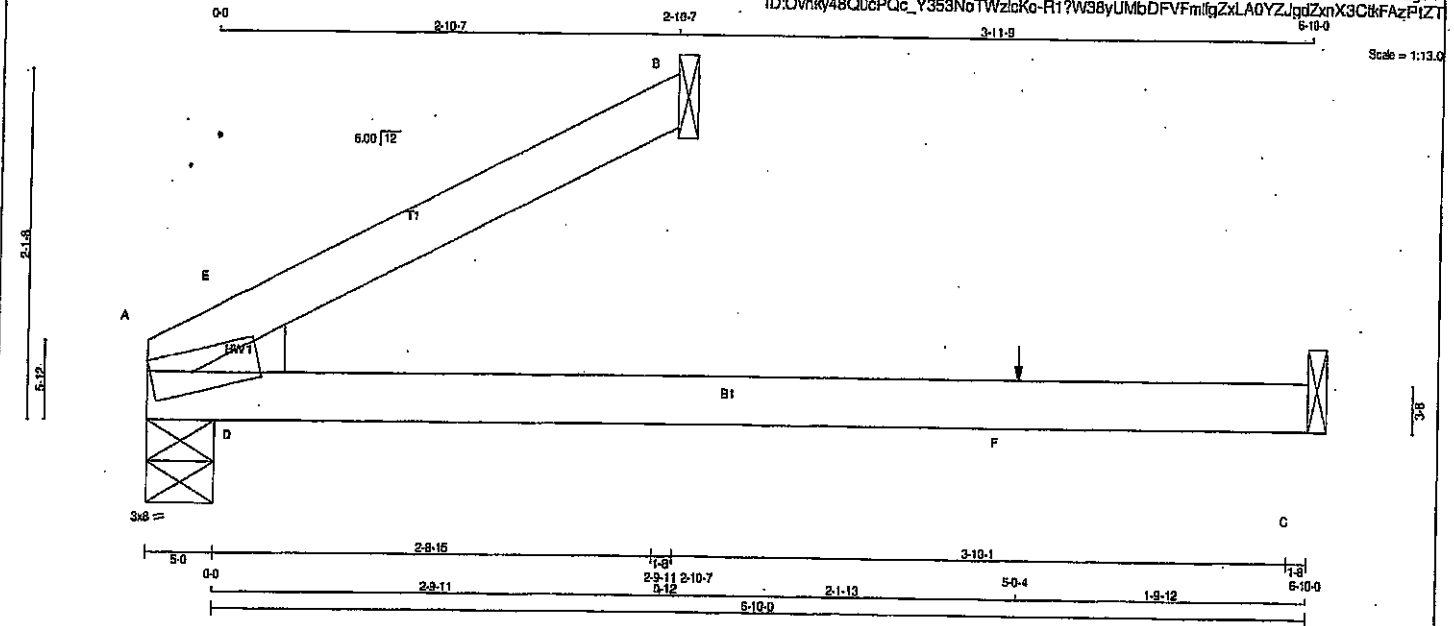

TOTAL WEIGHT = 13 lb

LUMBER

N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR
A - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	-W	LEN	Y	X
A	TBMH1-m	MT20	3.0	6.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG	HEEL
	VERT	HORZ	DOWN	HORZ			
A	209	0	209	0	5-0	5-0	2x4 L
B	165	0	166	0	1-8	1-8	
C	60	0	61	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) A, C

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX/MIN. COMPONENT REACTIONS					SOIL
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	
A	150	89/0	0/0	0/0	0/0	61.0	0.0
B	118	75/0	0/0	0/0	0.0	43.0	0.0
C	47	4/0	0/0	0/0	0.0	43.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LOC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
A-E	-113/0	-91.8	-91.8	0.16 (4)	D-E	0.183	0.00 (1)
E-B	0/20	-91.8	-91.8	0.21 (4)			
A-D	0/0	-18.5	-18.5	0.11 (4)			
D-F	0/0	-18.5	-18.5	0.19 (4)			
F-C	0/0	-18.5	-18.5	0.19 (4)			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LOC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	5-0-4	1	1	1	FRONT	VERT	TOTAL	--	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	5.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIQ 2011, TPIQ 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.24")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
 ALLOWABLE DEFL.(TL) = L/360 (0.24")
 CALCULATED VERT. DEFL.(TL) = L/904 (0.10")

CSI: TC=0.21/1.00 (B-E:4), BC=0.19/1.00 (C-D:4), WB=0.00/1.00 (D-E:1), SS=0.15/1.00 (A-E:4)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSD)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.07 (A) (INPUT = 0.90)
 JSI METAL= 0.01 (A) (INPUT = 1.00)

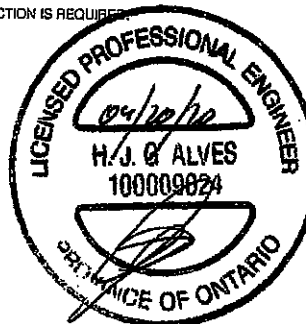


Structural component only
 DWG# T-2006484

JOB NAME 408165	TRUSS NAME J34	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 \$ Oct 28 2019 Mitek Industries, Inc. Fri Apr 17 08:44:17 2020 Page 1
ID:Ovhtky48Q0cPQc_Y353NoTWzicko-wDZvHUz67vL67PLyGO4AuNZhkI75IO1glsdHndzPzZS

Scale = 1:17.5

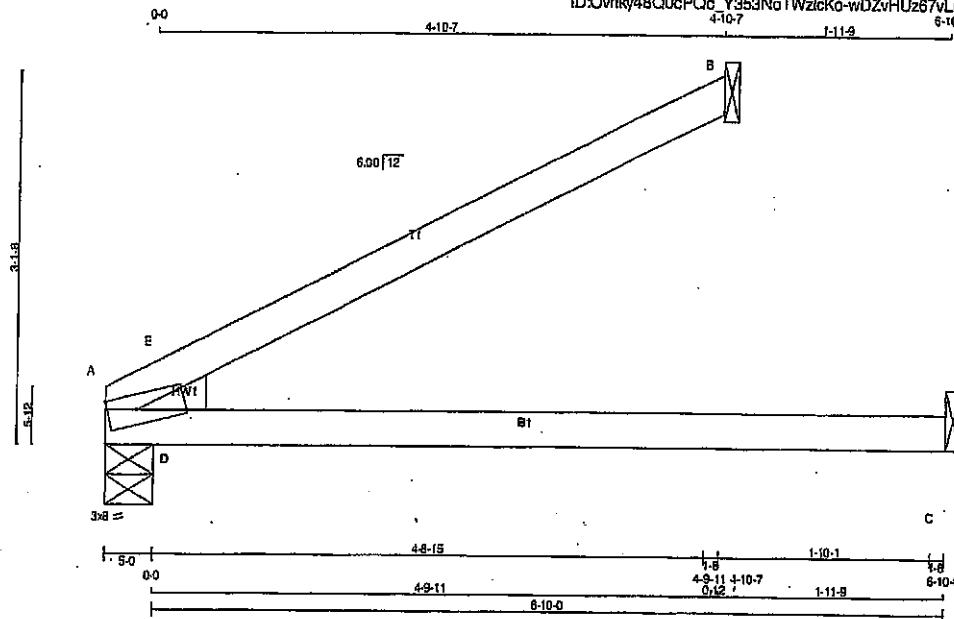

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TBMH1-m	MT20	3.0	8.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS									
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG	HEEL	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	WEDGE	
A	314	0	314	0	0	5-0	5-0	2x4 L	
B	225	0	225	0	0	1-8	1-8		
C	80	0	80	0	0	1-8	1-8		

SEE MITEK STANDARD DETAIL 697791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	223	140 / 0	0 / 0	0 / 0	0 / 0	83 / 0	0 / 0
B	157	117 / 0	0 / 0	0 / 0	0 / 0	40 / 0	0 / 0
C	61	13 / 0	0 / 0	0 / 0	0 / 0	48 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)
FR-TO				
A-E	-73 / 0	-91.8	-91.8	0.12 (4)
E-B	0 / 7	-91.8	-91.8	0.38 (1)
A-D	0 / 0	-18.5	-18.5	0.17 (1)
D-C	0 / 0	-18.5	-18.5	0.23 (1)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 8.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 085-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.24")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.08")
ALLOWABLE DEFL.(TL) = $L/360$ (0.24")
CALCULATED VERT. DEFL.(TL) = $L/455$ (0.19")

CSI: TC=0.38/1.00 (B-E:1), BC=0.23/1.00 (C-D:1), WS=0.00/1.00 (D-E:1), SSI=0.16/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1667 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.15 (A) (INPUT = 0.90)
JSI METAL = 0.02 (A) (INPUT = 1.00)

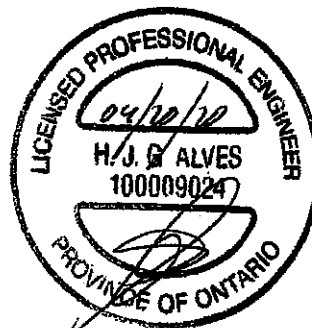


Structural component only
DWG# T-2006485

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408165	J35	3	1	TRUSS DESC.		

Tamrack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:44:18 2020 Page 1
ID:Ovhky48Q0cPQc_Y363NoTWzlcKo-QC7HlUqzkuCUzkZw8m5bPQb5wZ6L1pBqXWMqJ3zPlZR

Scale = 1:22.7

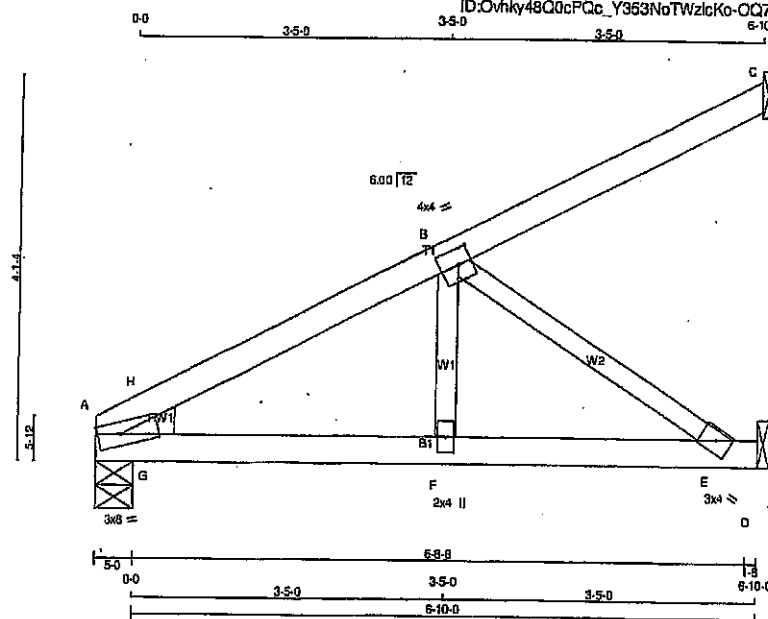

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
A - D	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A TBMH1-m	MT20	3.0	8.0		Edge
B TMWW-t	MT20	4.0	4.0	2.00	1.75
E BMW-w	MT20	3.0	4.0		
F BMW-w	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG	HEEL WEDGE
	VERT	HORZ	DOWN	HORZ			
A	400	0	400	0	5-0	5-0	2x4 L
C	125	0	125	0	1-8	1-8	
D	275	0	275	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS					SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	
A	283	185 / 0	0 / 0	0.0	0.0	97 / 0	0 / 0
C	86	88 / 0	0 / 0	0.0	0.0	17 / 0	0 / 0
D	196	116 / 0	0 / 0	0.0	0.0	80 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRAC LENGTH	MAX. CSI (LC)	
FR-TO		FROM	TO		FR-TO				
A-H	-517 / 0	-91.8	-91.8	0.02 (1)	6.25	F-B	0 / 147	0.04 (4)	
H-B	-481 / 0	-91.8	-91.8	0.12 (1)	6.25	B-E	-518 / 0	0.13 (1)	
B-C	-14 / 0	-91.8	-91.8	0.11 (1)	6.25	G-H	-61 / 16	0.00 (1)	
A-G	0 / 424	-18.5	-18.5	0.13 (1)	10.00				
G-F	0 / 424	-18.5	-18.5	0.14 (1)	10.00				
F-E	0 / 424	-18.5	-18.5	0.24 (1)	10.00				
E-D	0 / 0	-18.5	-18.5	0.17 (1)	10.00				

TOTAL WEIGHT = 3 X 23 = 68 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 38.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.24")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01")
ALLOWABLE DEFL. (TL) = $L/360$ (0.24")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.03")

CSI: TC=0.12/1.00 (B-H:1), BC=0.24/1.00 (E-F:1), WB=0.13/1.00 (B-E:1), SSI=0.21/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MT20	618	354
	1657	788
	1987	1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP=0.35 (E) (INPUT=0.90)
JSI METAL=0.19 (E) (INPUT=1.00)

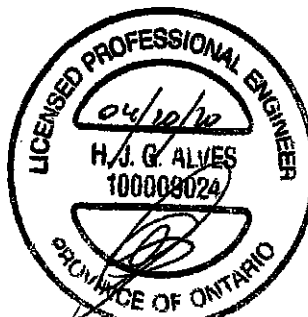

Structural component only
DWG# T-2008486

LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
 a) easier installation, b) higher capacities, c) lower installed
 cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.


Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.

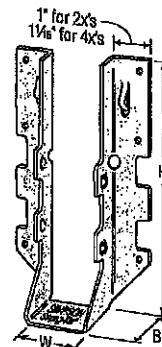


✓ LUS28

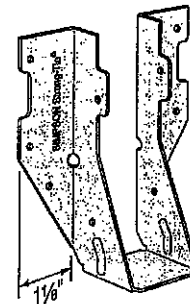


LU26L

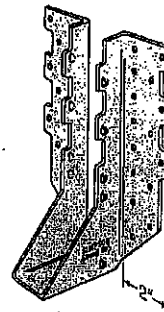

✓ HUS210
(HUS26, HUS28,
and HHUS similar)

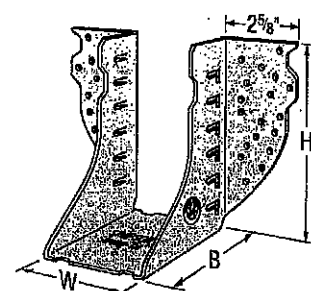


✓ HGUS28-2




✓ HHUS210-2



Double-Shear
Nailing
Top View





Double-Shear
Nailing
Side View;
Do not
bend tab



Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,580

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

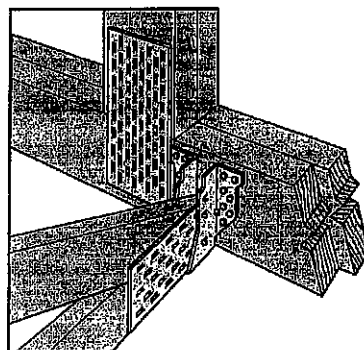

LJS26DS

LUL/LUS/LJS/HUS/HHUS/HGUS

HHUS/HGUS

See Hanger Options Information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value

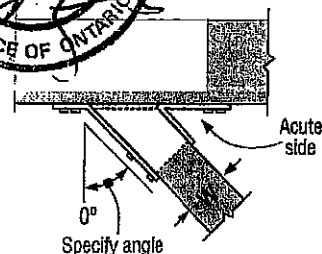

**Top View HHUS Hanger
Skewed Right**
(joist must be bevel cut)
All joist nails installed on the
outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _e ²	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
								lb.	lb.	lb.	lb.
								kN	kN	kN	kN
Single 2x Sizes											
SS LUS24	18	1 1/8	3 1/4	1 3/4	2 1/4	(4) 10d	(2) 10d	710	1625	645	1155
SS LU24L	22	1 1/8	3	1 3/4	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360	1020	320	725
SS LU26L	22	1 1/8	5	1 3/4	4 3/4	(6) 10d	(4) 10d x 1 1/2"	720	1605	645	1140
SS LUS26	18	1 1/8	4 3/4	1 3/4	3 3/4	(4) 10d	(4) 10d	1420	2170	1290	1630
SS HUS26	16	1 1/8	5 3/4	3	3 1/8	(14) 16d	(6) 16d	2705	4940	2065	3875
SS LJS26DS	18	1 1/8	5	3 1/2	4 3/4	(16) 16d	(6) 16d	2055	4265	1460	4115
SS HGUS26	12	1 1/8	5 3/4	5	4 3/4	(20) 16d	(8) 16d	2685	6625	2685	5700
SS LU28L	20	1 1/8	6 3/4	1 3/4	5 3/4	(8) 10d	(6) 10d x 1 1/2"	1140	2185	1020	1550
SS LUS28	18	1 1/8	6 3/4	1 3/4	3 3/4	(6) 10d	(4) 10d	1420	2520	1290	1790
SS HUS28	16	1 1/8	7 3/4	3	5 3/8	(22) 16d	(8) 16d	3605	5365	2675	4345
SS HGUS28	12	1 1/8	7 3/4	5	6 3/4	(36) 16d	(12) 16d	3310	7675	3310	6900
SS LU210L	20	1 1/8	8	1 3/4	7 3/4	(10) 10d	(6) 10d x 1 1/2"	1140	2495	1020	1770
SS LUS210	18	1 1/8	7 3/4	1 3/4	3 3/4	(8) 10d	(4) 10d	1420	2785	1290	2210


1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_e is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girdler truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/4" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _a ³	Header	Joist	D-Fir-L		S-P-F	
								Uplift (K _D = 1.15)	Normal (K _D = 1.00)	Uplift (K _D = 1.15)	Normal (K _D = 1.00)
								lb.	lb.	lb.	lb.
								kN	kN	kN	kN
Double 2x Sizes											
■ LUS24-2	18	3 1/8	3 1/8	2	1 1/2	(4) 16d	(2) 16d	835	2020	590	1435
■ SS LUS26-2	18	3 1/8	4 1/8	2	4	(4) 16d	(4) 16d	3.71	8.99	2.62	6.38
■ HHUS26-2	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	1720	2595	1545	1920
■ HGUS26-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	7.65	11.54	6.87	8.54
■ SS LUS28-2	18	3 1/8	7	2	4	(6) 16d	(4) 16d	2850	7335	2065	5205
■ HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	12.68	32.63	9.20	23.15
■ HGUS28-2	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	4385	8950	3110	6355
■ SS LUS210-2	18	3 1/8	9	2	6	(8) 16d	(6) 16d	19.51	39.81	13.83	28.27
■ HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d	7.65	14.79	6.87	11.45
■ HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	3765	8940	2675	6345
■ SS LUS212-2	18	3 1/8	10 1/8	2	8	(10) 16d	(8) 16d	16.75	39.77	11.90	28.22
■ HHUS212-2	14	3 1/8	10 1/8	3	10 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
■ HGUS212-2	12	3 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	27.00	57.74	19.17	40.99
■ SS LUS214-2	18	3 1/8	12 1/8	2	10 1/8	(16) 16d	(12) 16d	2580	4500	2320	3195
■ HHUS214-2	14	3 1/8	12 1/8	3	12 1/8	(46) 16d	(16) 16d	11.48	20.02	10.32	14.21
■ HGUS214-2	12	3 1/8	12 1/8	4	12 1/8	(66) 16d	(22) 16d	4670	9660	4235	7000
■ SS LUS216-2	18	3 1/8	14 1/8	2	12 1/8	(22) 16d	(16) 16d	20.77	42.97	18.84	31.14
■ HHUS216-2	14	3 1/8	14 1/8	3	14 1/8	(56) 16d	(20) 16d	6840	14015	4855	10270
■ HGUS216-2	12	3 1/8	14 1/8	4	14 1/8	(76) 16d	(26) 16d	30.43	62.34	21.60	45.69
Triple 2x Sizes											
■ HGUS26-3	12	4 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
■ SS LUS28-3	18	4 1/8	7 1/8	2	6	(8) 16d	(6) 16d	19.51	39.81	13.83	28.27
■ HHUS28-3	14	4 1/8	7 1/8	3	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
■ HGUS28-3	12	4 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	27.00	57.74	19.17	40.99
■ SS LUS210-3	18	4 1/8	9	2	6	(8) 16d	(6) 16d	4670	9660	4235	7000
■ HHUS210-3	14	4 1/8	9 1/8	3	8	(30) 16d	(10) 16d	20.77	43.02	18.84	30.54
■ HGUS210-3	12	4 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	6840	14015	4855	10400
■ SS LUS212-3	18	4 1/8	10 1/8	2	8	(10) 16d	(8) 16d	30.43	65.14	21.60	46.26
■ HHUS212-3	14	4 1/8	10 1/8	3	10 1/8	(36) 16d	(12) 16d	4385	8950	3110	6355
■ HGUS212-3	12	4 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	19.51	39.81	13.83	28.27
■ SS LUS214-3	18	4 1/8	12 1/8	2	10 1/8	(16) 16d	(12) 16d	6070	12980	4310	9215
■ HHUS214-3	14	4 1/8	12 1/8	3	12 1/8	(46) 16d	(16) 16d	27.00	57.74	19.17	40.99
■ HGUS214-3	12	4 1/8	12 1/8	4	12 1/8	(66) 16d	(22) 16d	4670	9660	4235	7210
■ SS LUS216-3	18	4 1/8	14 1/8	2	12 1/8	(22) 16d	(16) 16d	20.77	45.17	18.84	32.07
■ HHUS216-3	14	4 1/8	14 1/8	3	14 1/8	(56) 16d	(20) 16d	6840	14015	4855	10400
■ HGUS216-3	12	4 1/8	14 1/8	4	14 1/8	(76) 16d	(26) 16d	30.43	65.14	21.60	46.26
■ SS LUS218-3	18	4 1/8	16 1/8	2	14 1/8	(26) 16d	(20) 16d	7640	14995	5425	10645
■ HHUS218-3	14	4 1/8	16 1/8	3	16 1/8	(66) 16d	(22) 16d	33.98	66.70	24.13	47.35
■ HGUS218-3	12	4 1/8	16 1/8	4	16 1/8	(86) 16d	(28) 16d	45.06	72.95	32.00	51.80
Quadruple 2x Sizes											
■ LUS46	18	3 1/8	4 1/8	2	3 1/8	(4) 16d	(4) 16d	1720	2595	1545	1920
■ SS LUS48	18	3 1/8	6 1/8	2	3 1/8	(6) 16d	(4) 16d	7.65	11.54	6.87	8.54
■ HHUS46	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	2540	7335	2065	5205
■ HGUS46	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	11.30	32.63	9.20	23.15
■ SS LUS48	18	3 1/8	6 1/8	2	3 1/8	(6) 16d	(4) 16d	4385	8950	3110	6355
■ HHUS48	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	19.51	39.81	13.83	28.27
■ HGUS48	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	7.65	14.79	6.87	11.45
■ SS LUS410	18	3 1/8	8 1/8	2	5 1/8	(8) 16d	(6) 16d	3765	8940	2675	6345
■ HHUS410	14	3 1/8	8 1/8	3	8 1/8	(30) 16d	(10) 16d	16.75	39.77	11.90	28.22
■ HGUS410	12	3 1/8	8 1/8	4	8 1/8	(46) 16d	(16) 16d	6070	12980	4310	9215
■ SS LUS412	18	3 1/8	10 1/8	2	8 1/8	(10) 16d	(8) 16d	27.00	57.74	19.17	40.99
■ HHUS412	14	3 1/8	10 1/8	3	10 1/8	(36) 16d	(12) 16d	2580	4500	2320	3195
■ HGUS412	12	3 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	11.48	20.02	10.32	14.21
■ SS LUS414	18	3 1/8	12 1/8	2	10 1/8	(16) 16d	(12) 16d	4670	9660	4235	7000
■ HHUS414	14	3 1/8	12 1/8	3	12 1/8	(46) 16d	(16) 16d	20.77	42.97	18.84	31.14
■ HGUS414	12	3 1/8	12 1/8	4	12 1/8	(66) 16d	(22) 16d	6840	14015	4855	10270
■ SS LUS416	18	3 1/8	14 1/8	2	12 1/8	(22) 16d	(16) 16d	30.43	62.34	21.60	45.69
■ HHUS416	14	3 1/8	14 1/8	3	14 1/8	(56) 16d	(20) 16d	45.06	72.95	32.00	51.80
■ HGUS416	12	3 1/8	14 1/8	4	14 1/8	(76) 16d	(26) 16d	45.06	72.95	32.00	51.80



Plated Truss Connectors


See footnotes
on p. 258.

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

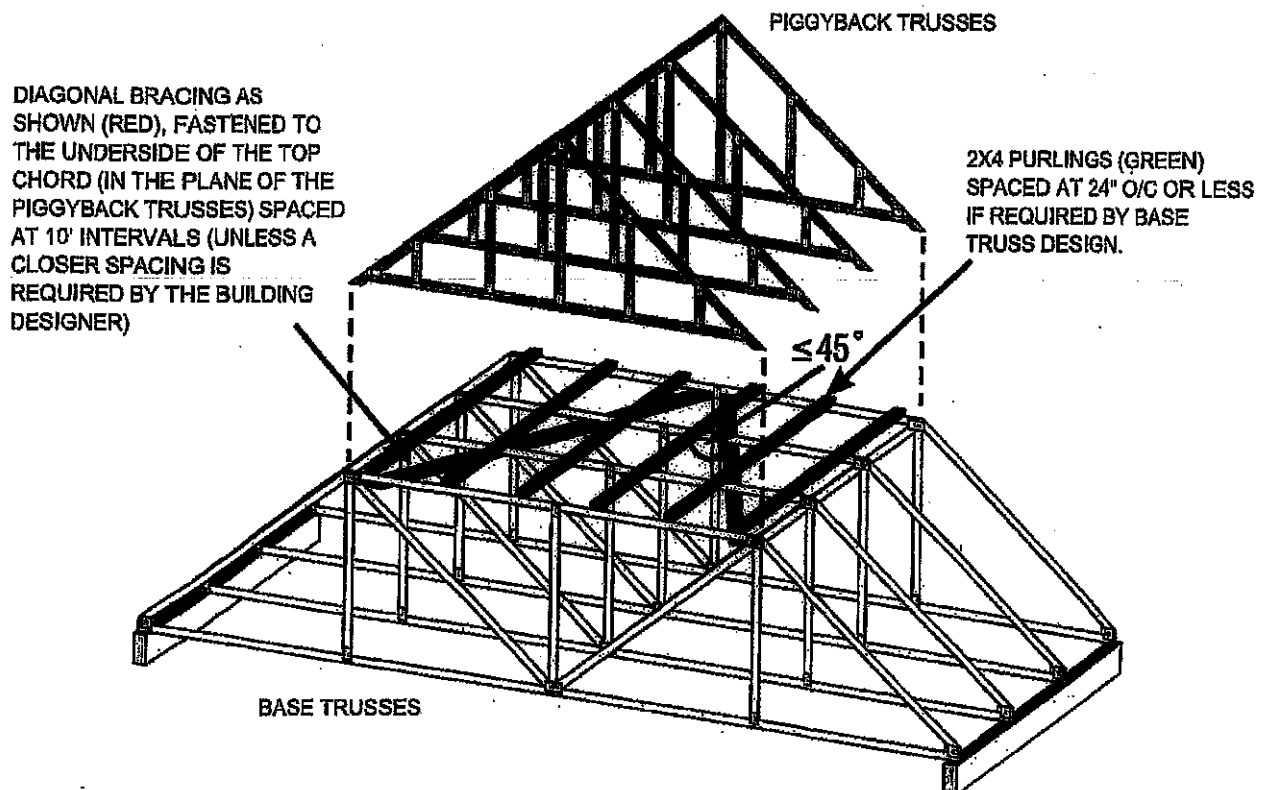

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

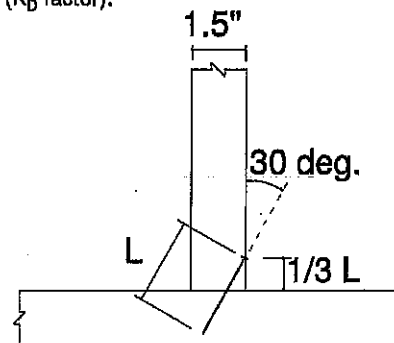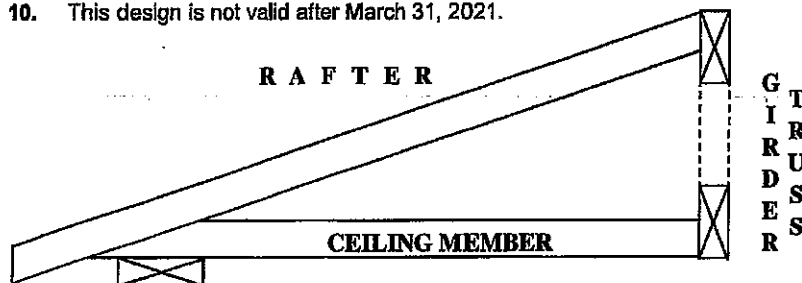

TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019

BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

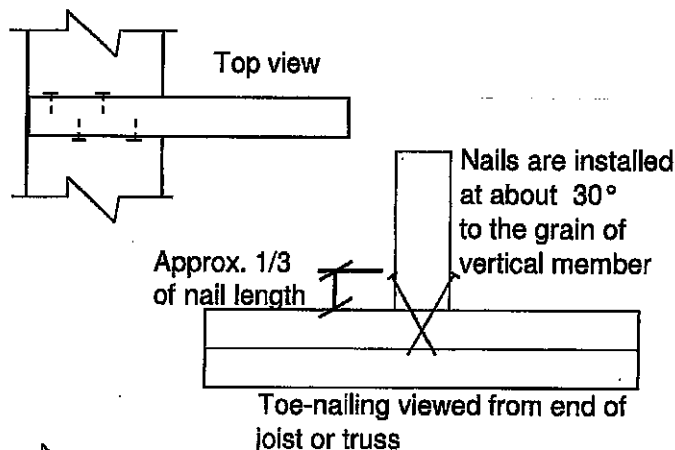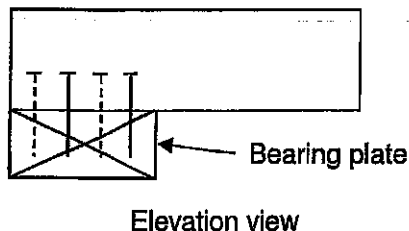

Toe-nailing on 2x4 Bearing Plate

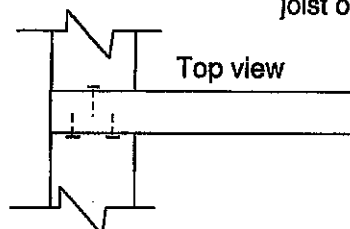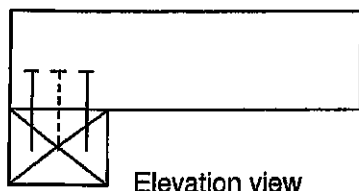


MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7


December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/8" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.

Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
- DSB-89: Design Standard for Bracing.
- BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

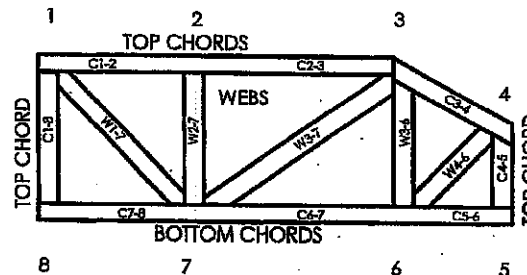

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MIL-7473C rev. 10-'08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1900218

Feb 09, 2018