


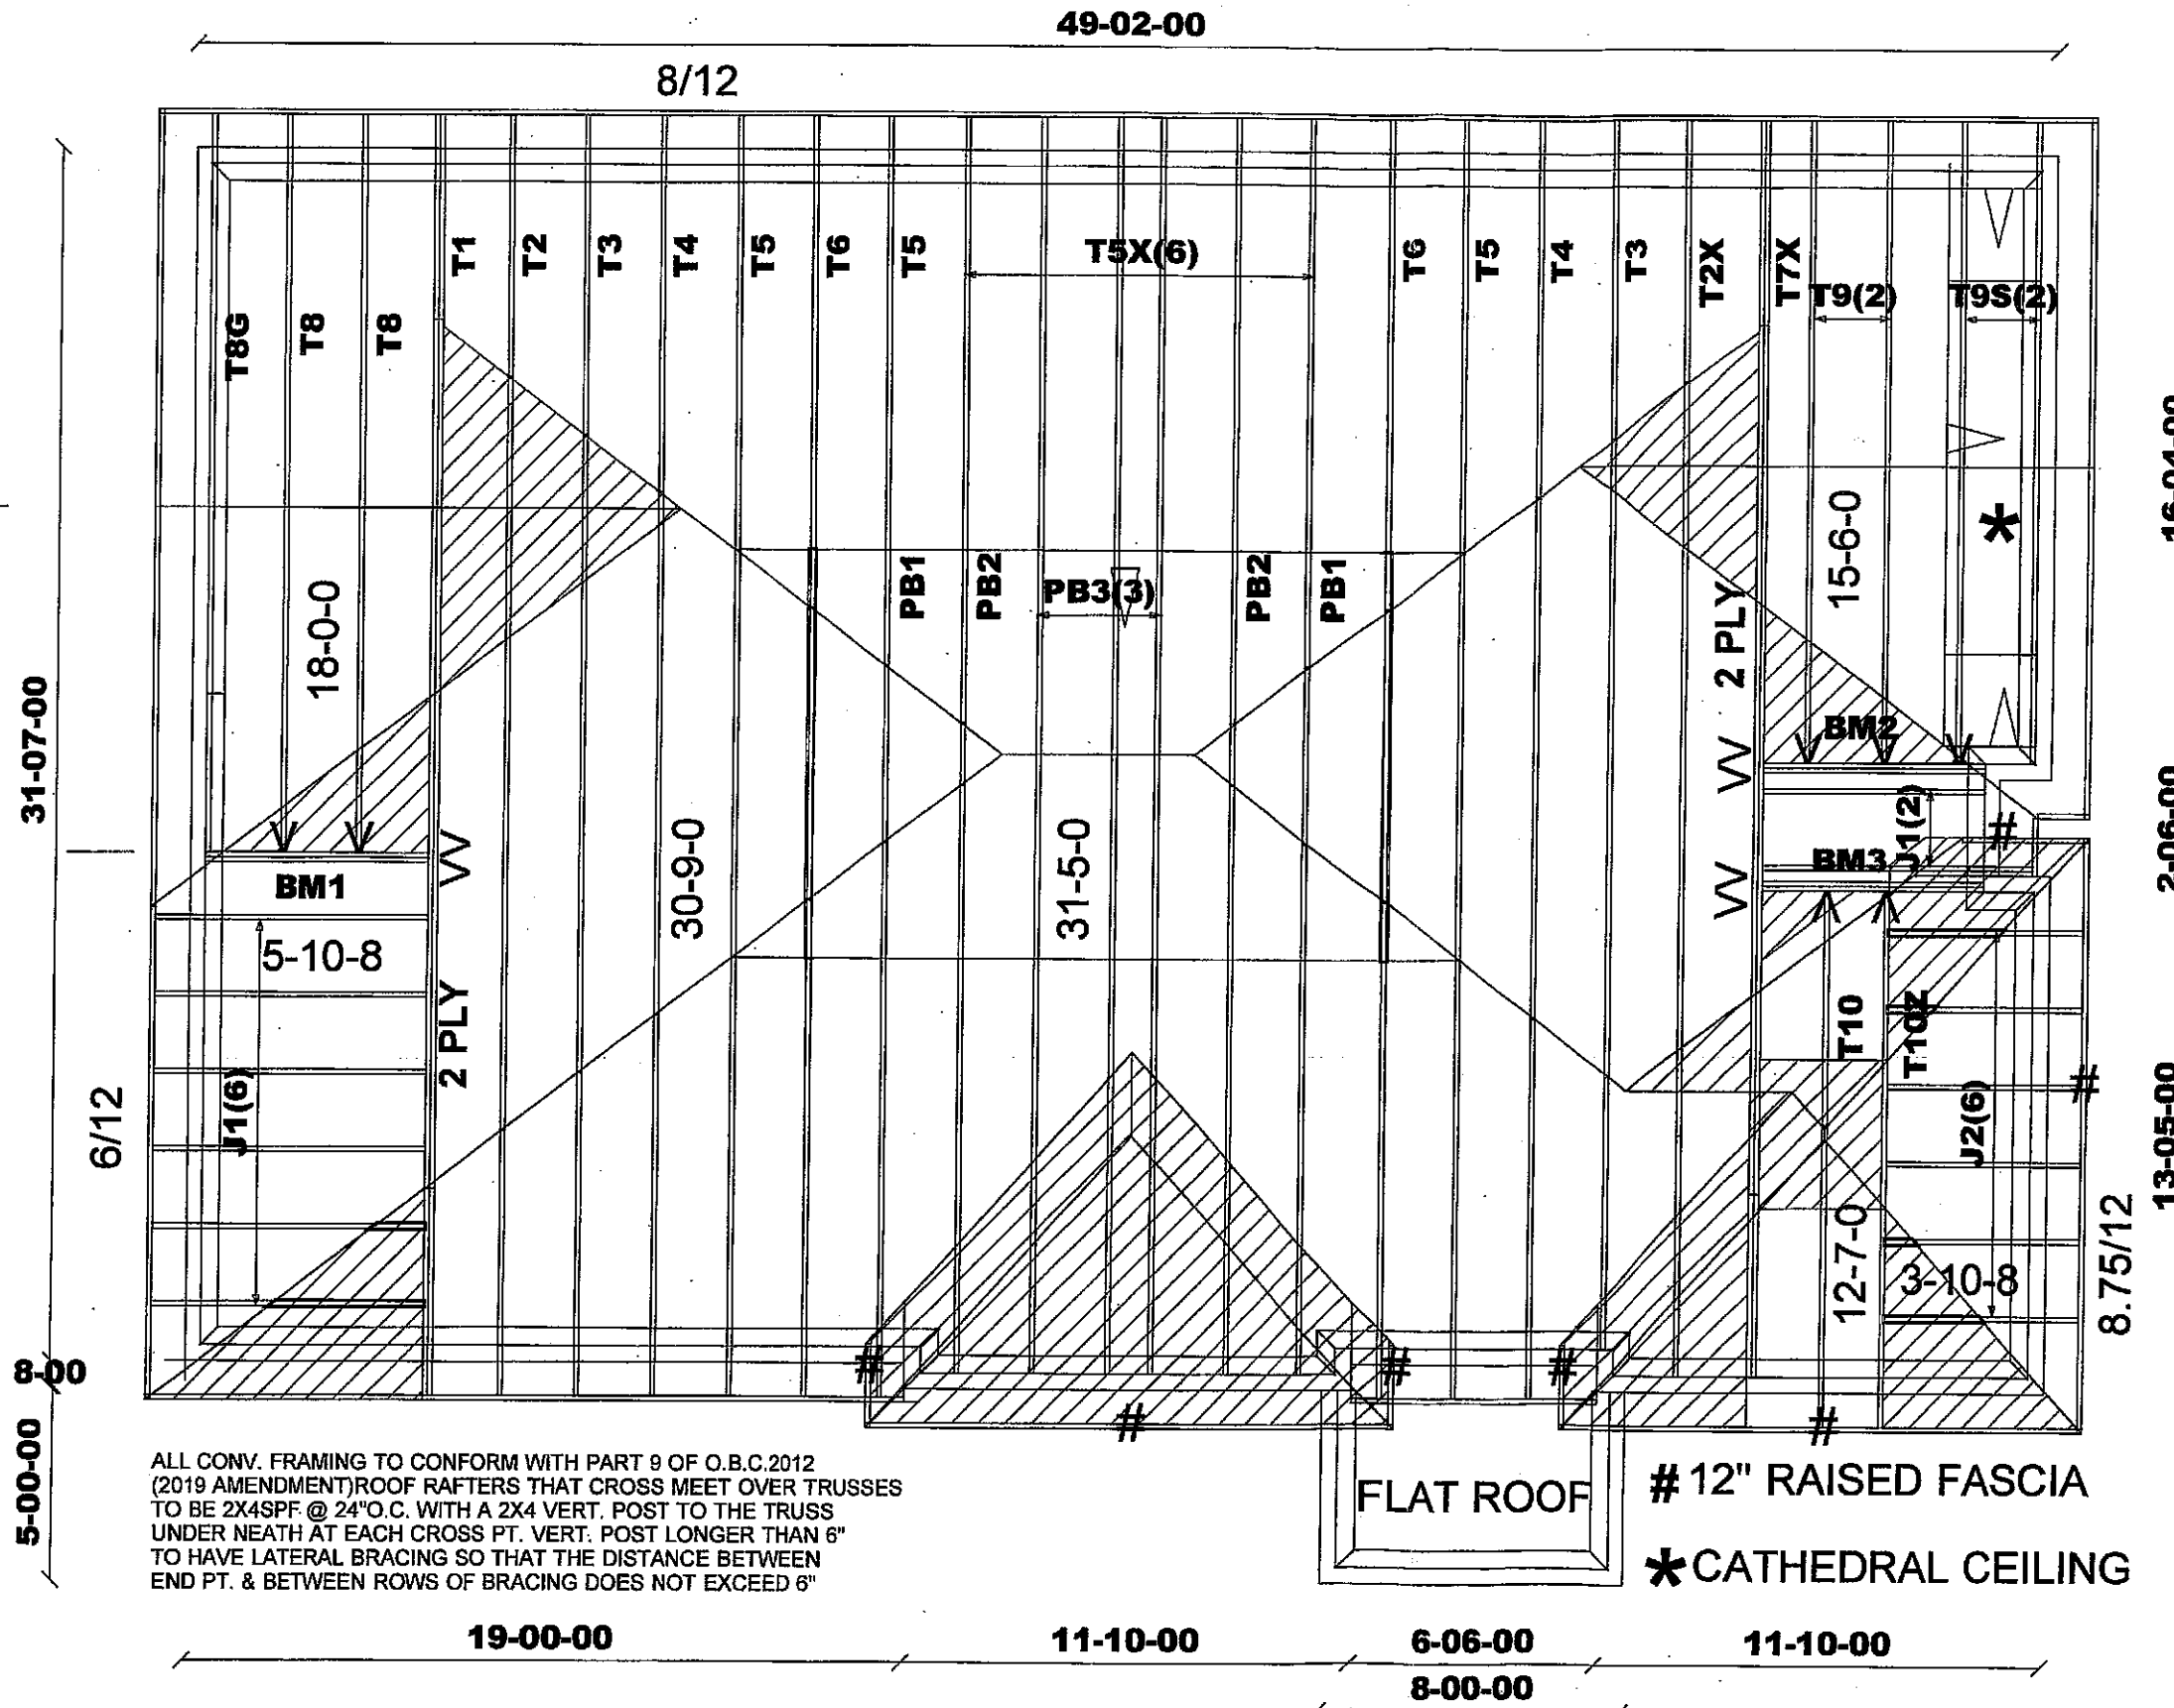

ASPHALT SHINGLES
12"FINISHED OH.
R.T.M.C.
2X6 EXTERIOR WALLS
2X6 FASCIA BOARD

CITY OF HAMILTON
Building Division

Permit No. 187706


HARDWARE: THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

LJS26DS - (V) THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

LUS26-2 - (VV) These drawings and/or specifications have been reviewed by

Nov 6/2020 JDC
FOR CHIEF BUILDING OFFICIAL DATE

DENOTES
CONV.
FRAMING



DESIGN CONFORMS
WITH O.B.C.2012 PART 9
(2019 AMENDMENT)
DESIGN LOADS:
SNOW LOAD 25.6 PSF
TC DEAD 6 PSF
BC LIVE 0 PSF
BC DEAD 7.4 PSF

BM1, BM2, BM3 = 2-2X10

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department

OCT 06 2020

M13123




Job Track: 51225
Plan Log: 202440
Layout ID: 408318

Builder / Location:
GREEN PARK HOMES / WATERDOWN
Project: RUSSELL GARDENS PH.3
Date: 2020-04-27 Sales: Mario DiCano Designer: ACJ/JG

Model / Elevation:
VALLEYCREEK 12/1

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

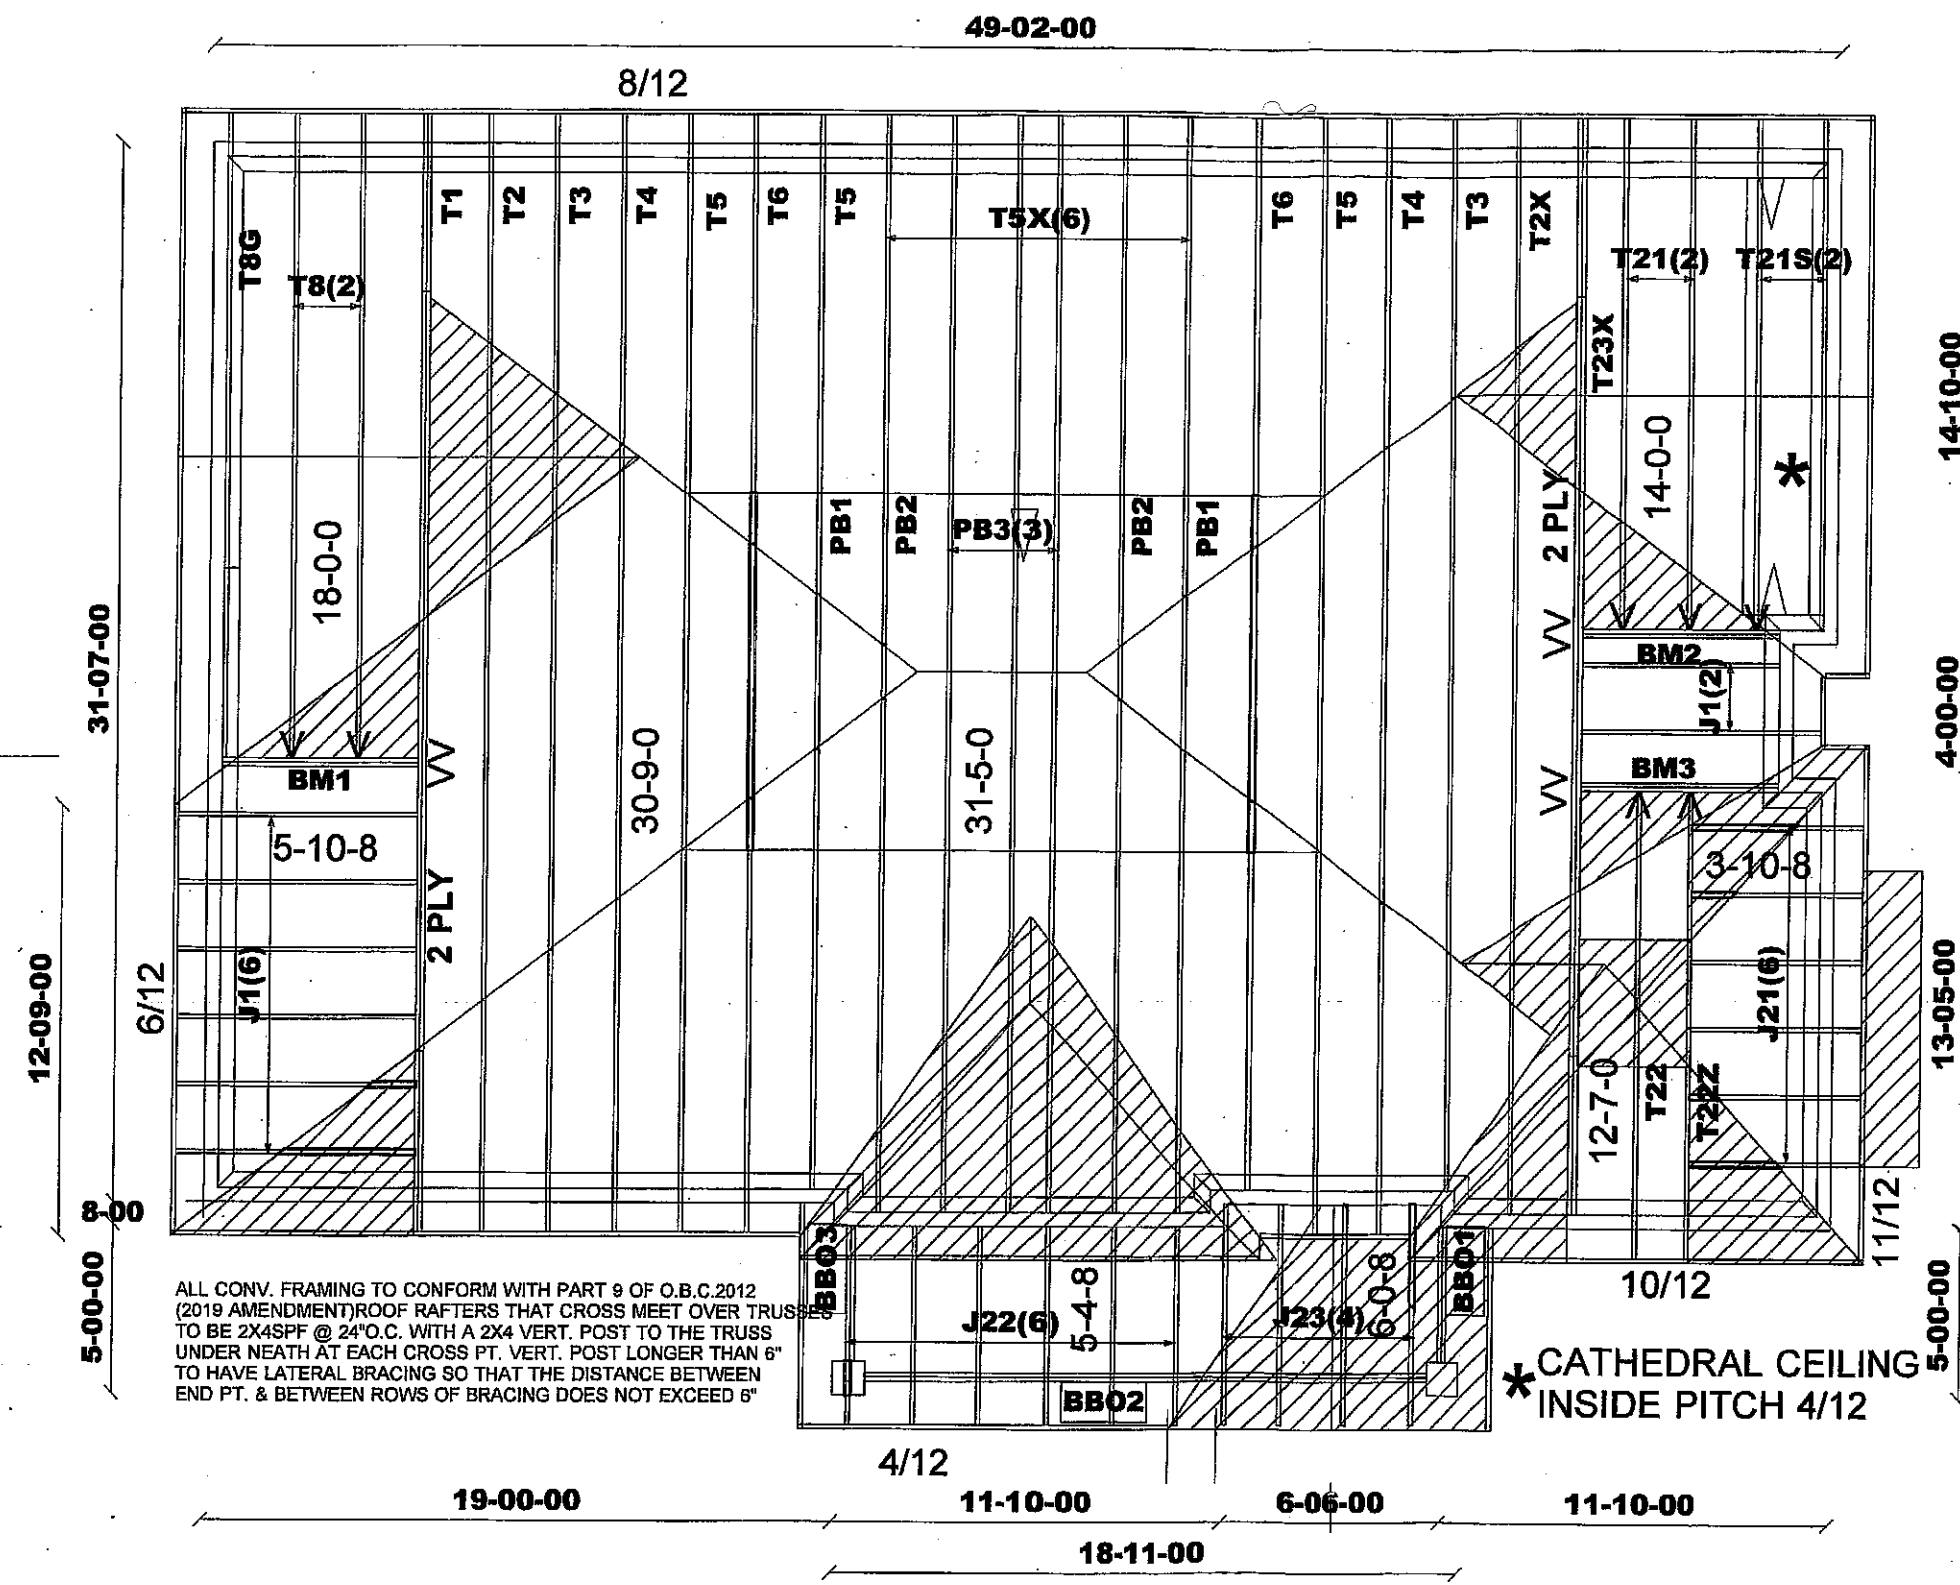

ALL CONV. FRAMING TO CONFORM WITH PART 9 OF O.B.C.2012 (2019 AMENDMENT) ROOF RAFTERS THAT CROSS MEET OVER TRUSSES TO BE 2X4SPF @ 24" O.C. WITH A 2X4 VERT. POST TO THE TRUSS UNDER NEATH AT EACH CROSS PT. VERT. POST LONGER THAN 6" TO HAVE LATERAL BRACING SO THAT THE DISTANCE BETWEEN END PT. & BETWEEN ROWS OF BRACING DOES NOT EXCEED 6"

* CATHEDRAL CEILING
INSIDE PITCH 4/12

ASPHALT SHINGLES
12" FINISHED OH.
R.T.M.C.
2X6 EXTERIOR WALLS
2X6 FASCIA BOARD

CITY OF HAMILTON
Building Division

HARDWARE:

LJS26DS - (V)
LUS26-2 - (VV)

Permit No. 187706
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
JDL Nov 6/2020
FOR CHIEF BUILDING OFFICIAL DATE

DENOTES
CONV.
FRAMING

DESIGN CONFORMS
WITH O.B.C.2012 PART 9
(2019 AMENDMENT)
DESIGN LOADS:
SNOW LOAD 25.6 PSF
TC DEAD 6 PSF
BC LIVE 0 PSF
BC DEAD 7.4 PSF

BM1, BM2, BM3 = 2-2X10


CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department

OCT 06 2020

REC BY _____ DATE _____
REF'D TO _____ DATE _____

M13128

 TAMARACK ROOF TRUSSES INC.	Job Track: 51225 Plan Log: 202440 Layout ID: 408319	Builder / Location: GREEN PARK HOMES / WATERDOWN Project: RUSSELL GARDENS PH.3 Date: 2020-04-27 Sales: Mario DiCano Designer: ACJ	Model / Elevation: VALLEYCREEK 12/2 Mitek ver 8.3.1.215 THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.
--	---	---	--

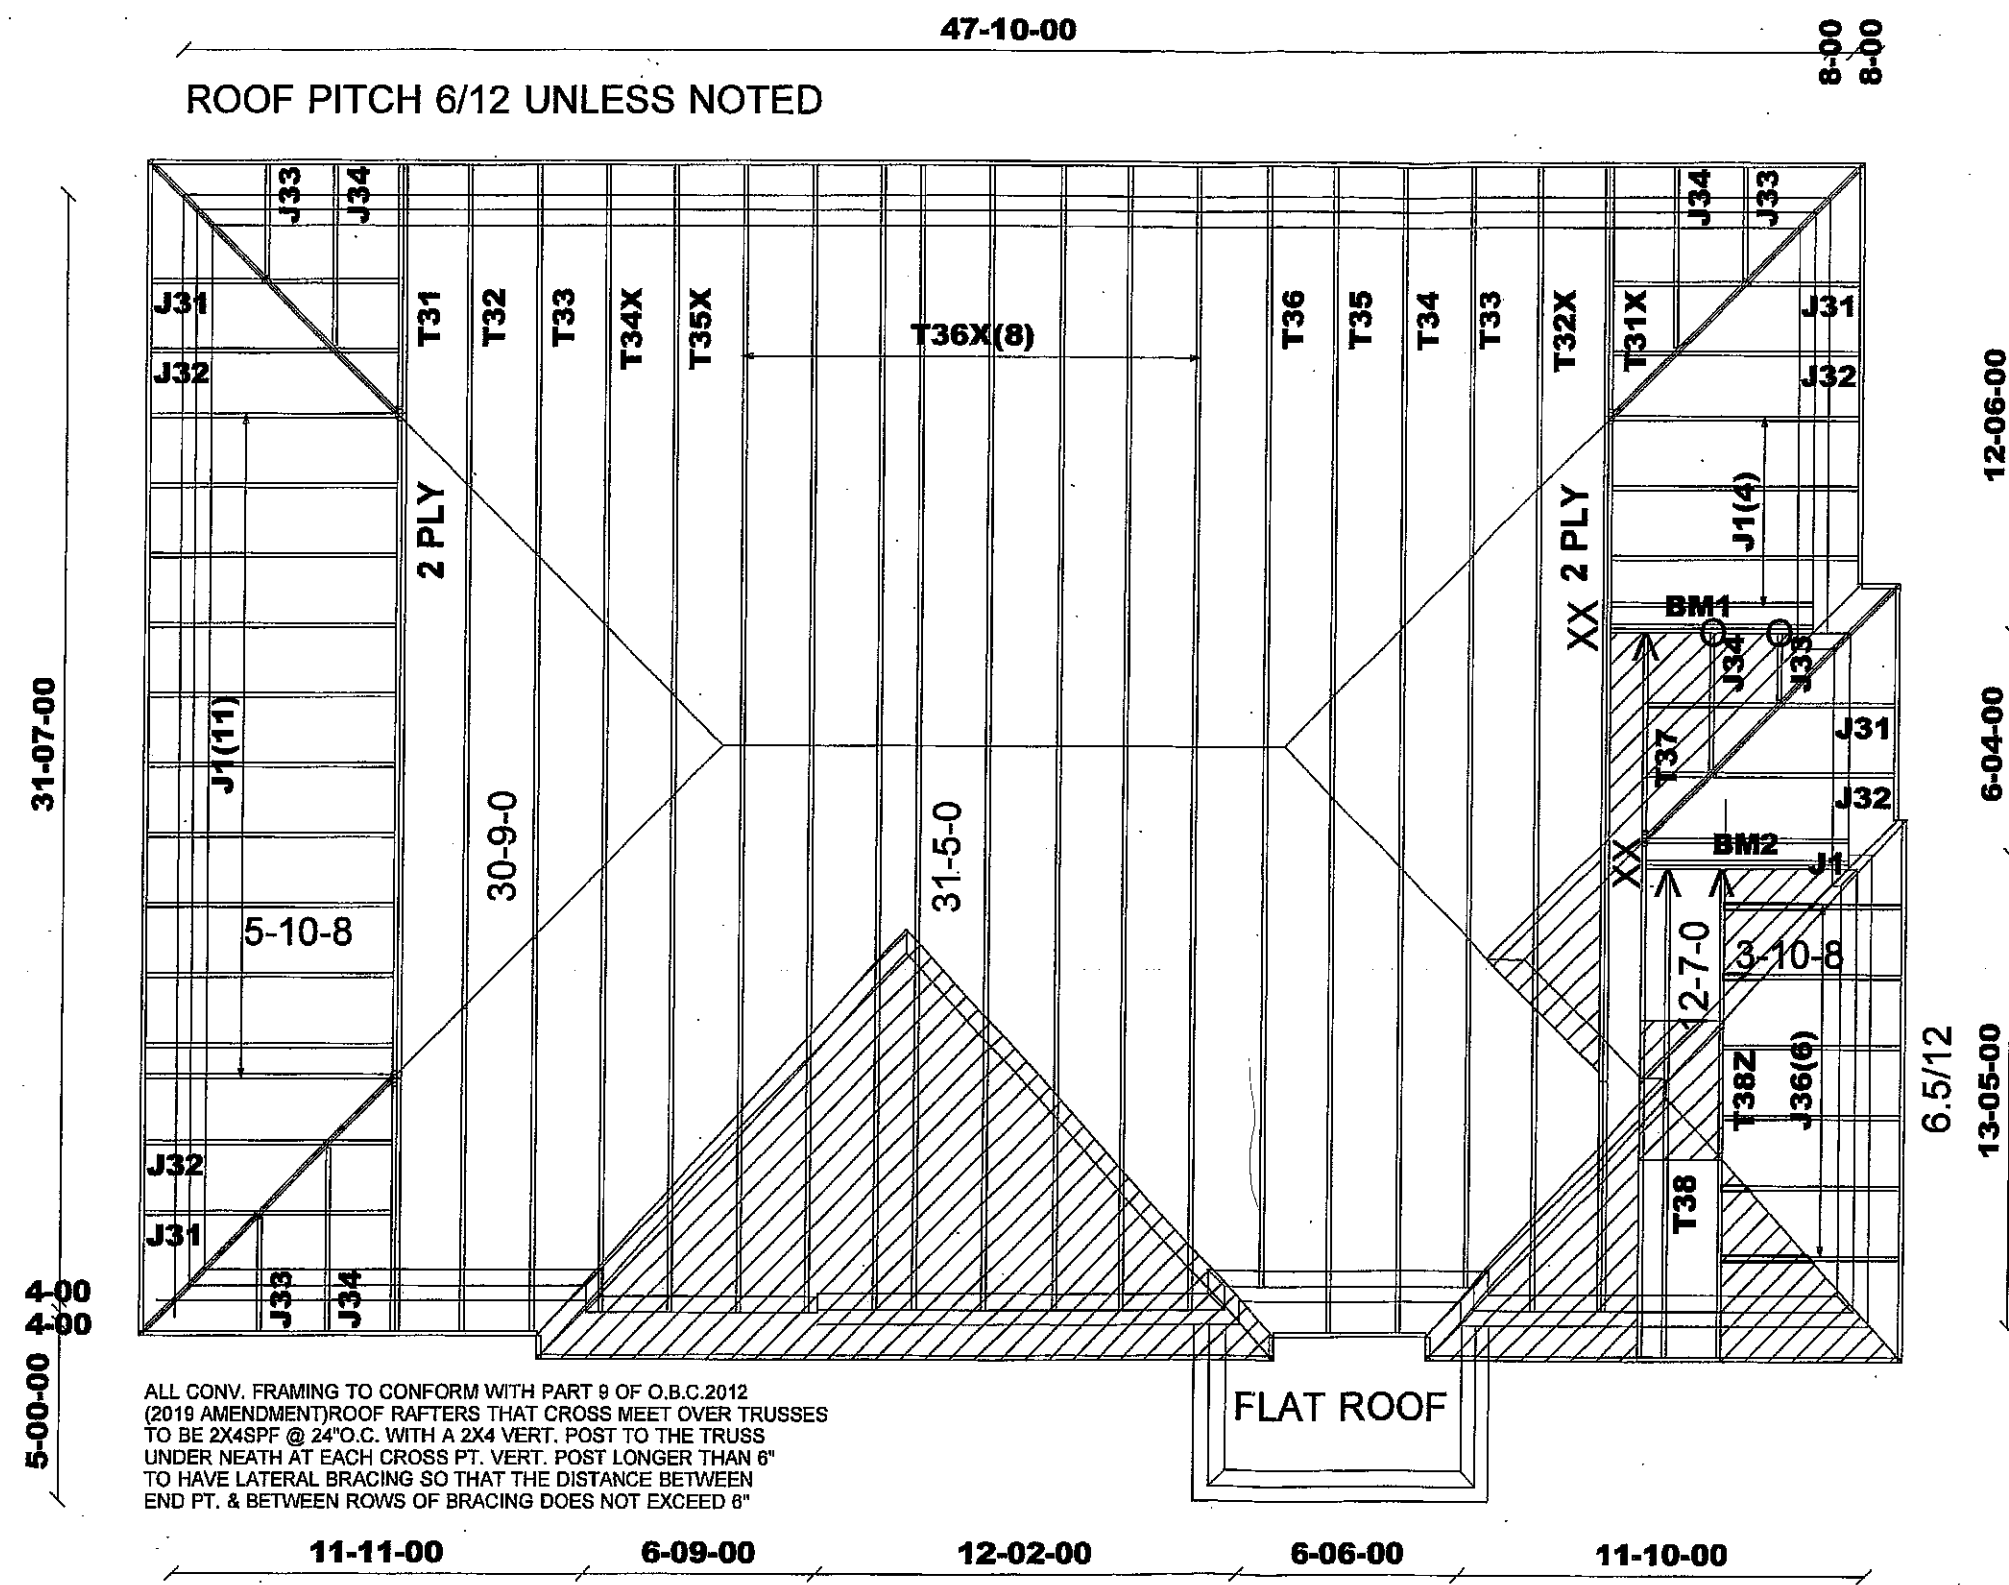

ASPHALT SHINGLES
12"FINISHED OH.
R.T.M.C.
2X6 EXTERIOR WALLS
2X6 FASCIA BOARD

CITY OF HAMILTON
Building Division
Permit No. 187706

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

HARDWARE.
LUS24 - (O)
LJS26DS - (V) JDL
HGUS26-2 - (XX)

Nov 6/2020
DATE

FOR CHIEF BUILDING OFFICIAL


DENOTES
CONV.
FRAMING

DESIGN CONFORMS
WITH O.B.C.2012 PART 9
(2019 AMENDMENT)
DESIGN LOADS:
SNOW LOAD 25.6 PSF
TC DEAD 6 PSF
BC LIVE 0 PSF
BC DEAD 7.4 PSF

BM1, BM2 = 2-2X12

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department
OCT 06 2020

REC BY _____ DATE _____
REF'D TO _____ DATE _____



Job Track: 51225
Plan Log: 202440
Layout ID: 408320

Builder / Location:
GREEN PARK HOMES / WATERDOWN

Project: RUSSELL GARDENS PH.3

Date: 2020-04-27 Sales: Mario DiCano Designer: AC/IG

Model / Elevation:
VALLEYCREEK 12/3

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: VALLEYCREEK 12
 Lot #:
 Elevation: 1

Job Track: 51225
 Plan Log: 202440
 Layout ID: 408318
 Ref #
 Page: 1 of 2
 Date: 04-27-2020
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	8/12	30-09-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	279.28 171.33		
	1	T2 Hip	8/12	30-09-00	5-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	121.17 75.33		
	1	T2X Hip	8/12	30-09-00	5-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	121.46 75.67		
	2	T3 Hip	8/12	30-09-00	6-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	262.37 164.00		
	2	T4 Hip	8/12	30-09-00	7-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	266.92 168.33		
	3	T5 Hip	8/12	30-09-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	417.8 261.00		
	6	T5X Piggyback Base	8/12	30-09-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	837.32 531.00		
	2	T6 Hip	8/12	30-09-00	9-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	278.58 173.33		
	1 2-ply	T7X Hip Girder	8/12	31-05-00	4-01-04	2 x 4 2 x 6	1-03-08	1-04-13 11-08	282.1 174.67		
	2	T8 Common	8/12	18-00-00	7-04-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	158.58 100.67		
	1	T8G GABLE	8/12	18-00-00	7-04-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	81.47 52.83		
	2	T9 Common	8/12	15-06-00	6-06-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	132.28 84.00		
	2	T9S Roof Special	8/12 5/12	15-06-00	6-06-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	130.53 86.33		
	1	T10 Hip	8/12	12-07-00	5-03-12	2 x 4	1-03-08	2-04-13 2-04-13	57.21 35.67		



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: VALLEYCREEK 12
 Lot #:
 Elevation: 2

Job Track: 51225
 PlanLog: 202440
 Layout ID: 408319
 Ref #
 Page: 1 of 2
 Date: 04-27-2020
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	8 /12	30-09-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	279.28 171.33		
	1	T2 Hip	8 /12	30-09-00	5-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	121.17 75.33		
	1	T2X Hip	8 /12	30-09-00	5-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	121.46 75.67		
	2	T3 Hip	8 /12	30-09-00	6-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	262.37 164.00		
	2	T4 Hip	8 /12	30-09-00	7-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	265.92 168.33		
	3	T5 Hip	8 /12	30-09-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	417.8 261.00		
	6	T5X Piggyback Base	8 /12	30-09-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	837.32 531.00		
	2	T6 Hip	8 /12	30-09-00	9-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	278.58 173.33		
	2	T8 Common	8 /12	18-00-00	7-04-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	158.58 100.67		
	1	T8G GABLE	8 /12	18-00-00	7-04-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	81.47 52.83		
	2	T21 Common	8 /12	14-00-00	6-00-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	121.02 76.67		
	2	T21S Scissor	8 /12 4 /12	14-00-00	6-00-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	118.93 79.33		
	1	T22 Hip	10 /12	12-07-00	5-03-12	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	58.29 37.67		
	1	T22Z Hip Girder	10 /12	12-07-00	5-03-12	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	58.29 37.67		

 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST			
	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: VALLEYCREEK 12 Lot #: Elevation: 2	Job Track: 51225 PlanLog: 202440 Layout ID: 408319 Ref # Page: 2 of 2 Date: 04-27-2020 Designer: Andrew Conway Sales Rep: Mario DiCano		

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T23X Hip Girder	8 /12	31-05-00	4-01-04	2 x 4 2 x 6	1-03-08	1-04-13 11-08	282.1 174.67		
	2	PB1 Piggyback	8 /12	10-07-11	2-00-00	2 x 4			59.3 39.67		
	2	PB2 Piggyback	8 /12	10-07-11	3-00-00	2 x 4			60.88 41.00		
	3	PB3 Piggyback	8 /12	10-07-11	3-06-09	2 x 4			81.86 52.60		
	8	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	134.36 85.33		
	6	J21 Jack-Open	11 /12	3-10-08	5-03-12	2 x 4	1-03-08	1-09-02 5-03-12	96.71 65.00		
	6	J22 Jack-Open	4 /12	5-04-08	2-06-06	2 x 4	1-03-08	3-15 1-10-04	85.52 56.00		
	4	J23 Jack-Open	4 /12	6-00-08	2-09-00	2 x 4	1-03-08	3-15 2-00-15	63.26 40.00		

TOTAL # TRUSS= 61 TOTAL BFT OF ALL TRUSSES= 2559 BFT. TOTAL WEIGHT OF ALL TRSSES 4044.54 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
7	Hardware	LJS26DS	
3	Hardware	LUS26-2	

TOTAL NUMBER OF
ITEMS= 10



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: VALLEYCREEK 12
 Lot #:
 Elevation: 3


Job Track: 51225
 PlanLog: 202440
 Layout ID: 408320
 Ref #
 Page: 1 of 2
 Date: 04-27-2020
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T31 Hip Girder	6 /12	30-09-00	4-01-04	2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	322.41 204.00		
	1 2-ply	T31X Hip Girder	6 /12	30-09-00	4-01-04	2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	309.5 191.33		
	1	T32 Hip	6 /12	30-09-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	120.33 74.83		
	1	T32X Hip	6 /12	30-09-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	120.8 75.17		
	2	T33 Hip	6 /12	30-09-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	251.59 157.33		
	1	T34 Hip	6 /12	30-09-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	127.26 78.67		
	1	T34X Hip	6 /12	30-09-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	129.62 81.33		
	1	T35 Hip	6 /12	30-09-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	128.26 80.00		
	1	T35X Hip	6 /12	30-09-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	130.94 82.83		
	1	T36 Common	6 /12	30-09-00	8-10-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	128.62 79.83		
	8	T36X Common	6 /12	30-09-00	8-10-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1032.72 652.00		
	1	T37 Roof Special Girder	6 /12	19-04-00	4-01-04	2 x 4 2 x 6	1-03-08	1-02-00 1-02-00	100.16 63.83		
	1	T38 Hip	6 /12	12-07-00	3-03-14	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	49.83 32.50		
	1	T38Z Hip Girder	6 /12	12-07-00	3-03-14	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	49.83 32.50		

DELIVERY SHIPLIST				
	Lumber Yard:	TAMARACK LUMBER	Job Track:	51225
	Builder:	GREEN PARK HOMES	PlanLog:	202440
	Project:	RUSSELL GARDENS PH.3	Layout ID:	408320
	Location:	WATERDOWN	Ref #	
	Model:	VALLEYCREEK 12	Page:	2 of 2
	Lot #:		Date:	04-27-2020
	Elevation:	3	Designer:	Andrew Conway
		Sales Rep:	Mario DiCano	

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	16	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	268.71 170.67		
	4	J31 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 3-11-09	1-02-00 2-01-08	46.97 29.33		
	4	J32 Jack-Open	6 /12	3-10-15	3-01-08	2 x 4	1-03-08 1-11-09	1-02-00 3-01-08	57.17 34.67		
	4	J33 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 1-01	1-02-00 2-01-08	29.29 18.67		
	4	J34 Jack-Open	6 /12	2-00-00	3-01-08	2 x 4	1-03-08 1-10-15	1-02-00 2-02-00	39.49 24.00		
	6	J36 Jack-Open	6.5 /12	3-10-08	3-03-14	2 x 4	1-03-08	1-02-11 3-03-14	73 48.00		


TOTAL # TRUSS= 62 TOTAL BFT OF ALL TRUSSES= 2211.49 BFT. TOTAL WEIGHT OF ALL TRSSES 3516.5 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
3	Hardware	LJS26DS	
2	Hardware	LUS24	
2	Hardware	HGUS26-2	

TOTAL NUMBER OF
ITEMS= 7

JOB NAME 408318	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 15:32:49 2020 Page 1	
ID:HJ7_mBNWkyCmBzl hTT7DUzjdZA-eaQ1bwIbdYDpLnfcH2YKPwqzMU0ajFWp2czNp0S					
Scale = 1:50.0					

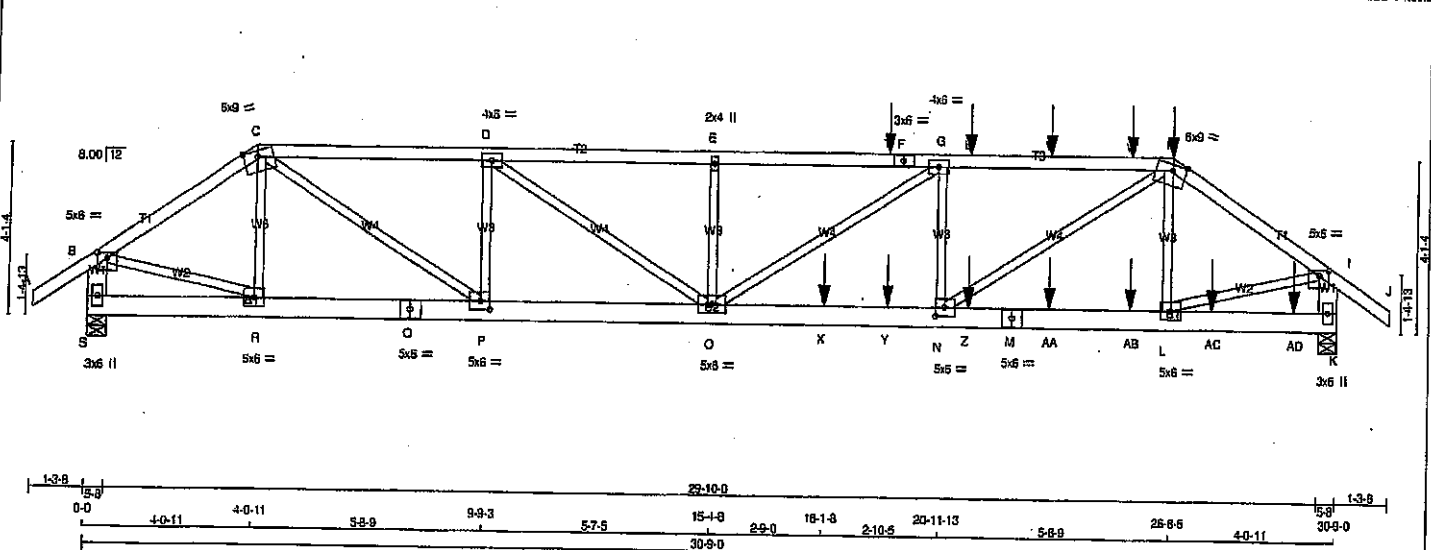

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x6	DRY	No.2
K - I	2x6	DRY	No.2
S - Q	2x6	DRY	1850F 1.5E
Q - M	2x6	DRY	1850F 1.5E
M - K	2x6	DRY	1850F 1.5E

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	12	TOP
C-F	12	SIDE(0.0)
F-H	12	SIDE(0.0)
H-J	12	SIDE(0.0)
S-B	2	TOP
K-I	2	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S-Q	2	TOP
Q-M	2	SIDE(0.0)
M-K	2	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	UP	IN-SX
S 2608	0	0	5-8
K 3401	0	0	5-8

UNFACTORED REACTIONS						
1ST CASE	MAX.	MIN.	COMPONENT	REACTIONS		
JT COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S 1838	1234	0	0	0	604	0
K 2400	1605	0	0	0	795	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO				FR-TO			
A-B	0 35	-91.8	-91.8 0.07 (1)	10.00	R-C	-431	0.05 (1)
B-C	-3017	0	-91.8	-91.8 0.19 (1)	5.13	C-P	0 3123
C-D	-5112	0	-91.8	-91.8 0.40 (1)	3.56	P-D	-1778
D-E	-6908	0	-91.8	-91.8 0.52 (1)	3.38	D-O	0 2155
E-T	-6906	0	-91.8	-91.8 0.66 (1)	3.20	O-E	-461
T-F	-6906	0	-91.8	-91.8 0.68 (1)	3.20	O-G	0 427
F-G	-6908	0	-91.8	-91.8 0.68 (1)	3.20	N-G	-1129
G-U	-6550	0	-91.8	-91.8 0.64 (1)	3.30	N-H	0 3898
U-V	-6550	0	-91.8	-91.8 0.64 (1)	3.30	L-H	-765
V-W	-6550	0	-91.8	-91.8 0.64 (1)	3.30	B-R	0 2577
W-H	-6550	0	-91.8	-91.8 0.64 (1)	3.30	L-I	0 3399
H-I	-3979	0	-91.8	-91.8 0.22 (1)	4.57		
I-J	0 35	-91.8	-91.8 0.07 (1)	10.00			
S-B	-2592	0	0.0	0.0 0.09 (1)	7.81		
K-I	-3320	0	0.0	0.0 0.12 (1)	7.63		
S-R	0 0	-18.5	-18.5 0.03 (1)	10.00			
R-Q	0 2494	-18.5	-18.5 0.15 (1)	10.00			
Q-P	0 2494	-18.5	-18.5 0.15 (1)	10.00			
P-O	0 5112	-18.5	-18.5 0.34 (1)	10.00			
O-X	0 6550	-18.5	-18.5 0.67 (1)	10.00			
X-Y	0 6550	-18.5	-18.5 0.67 (1)	10.00			
Y-N	0 6550	-18.5	-18.5 0.67 (1)	10.00			
N-Z	0 3284	-18.5	-18.5 0.27 (1)	10.00			
Z-M	0 3284	-18.5	-18.5 0.27 (1)	10.00			
M-AA	0 3284	-18.5	-18.5 0.27 (1)	10.00			
AA-AB	0 3284	-18.5	-18.5 0.27 (1)	10.00			
AB-L	0 3284	-18.5	-18.5 0.27 (1)	10.00			
L-AC	0 0	-18.5	-18.5 0.03 (1)	10.00			
AC-AD	0 0	-18.5	-18.5 0.03 (1)	10.00			
AD-K	0 0	-18.5	-18.5 0.03 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	
H	28-8-5	-50	-56		FRONT	VERT	DEAD
T	19-8-4	-110	-110		FRONT	VERT	SNOW
U	21-8-4	-110	-110		FRONT	VERT	TOTAL
V	23-8-4	-110	-110		FRONT	VERT	TOTAL
W	25-8-4	-110	-110		FRONT	VERT	TOTAL
X	18-1-8	-1452	-1452		FRONT	VERT	TOTAL
Y	19-8-4	-26	-26		FRONT	VERT	TOTAL
Z	21-8-4	-26	-26		FRONT	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.5 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 33.0 PSF

SPACING = 24.0 IN./C/O

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/970 (0.38")

CSI: TC=0.66/1.00 (E-G:1), BC=0.67/1.00 (N-O:1), WB=0.48/1.00 (H-N:1), SS=0.26/1.00 (N-O:1)

DOL LUMBER=1.00 NAIL=1.00 L5 BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES			
PLATE GRIP(DRY)	SHEAR	SECTION	
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618	354	1567
	788	1967	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (R) (INPUT = 0.80)

JSI METAL= 0.41 (R) (INPUT = 1.00)

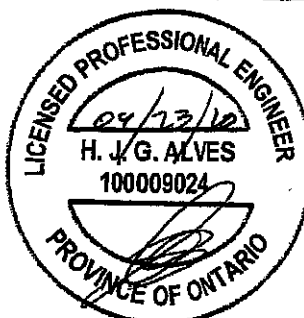

Structural component only
DWG# T-2006818

JOB NAME 408318	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 23 15:32:49 2020 Page 2
ID:HJ7 mBNWkyCmBzl hTT?DUzidZA-aaQ1bwlibdYDpLnlfCH2IVKPwqzMUC0aIFWp2czNp0S

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
B	TMW-p	MT20	5.0	6.0	1.50	3.00
C	TTWW-m	MT20	6.0	9.0	1.75	4.00
D	TMWW-t	MT20	4.0	6.0		
E	TMW-w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMWW-t	MT20	4.0	6.0		
H	TTWW-m	MT20	6.0	9.0	1.75	4.00
I	TMW-p	MT20	5.0	6.0	1.50	3.00
K	BMV1-p	MT20	3.0	6.0		
L	BMWW-t	MT20	5.0	6.0		
M	BS-t	MT20	5.0	6.0		
N	BMWW-t	MT20	5.0	6.0	2.50	2.75
O	BMWWWW-t	MT20	5.0	6.0		
P	BMWW-t	MT20	5.0	6.0	2.50	2.75
Q	BS-t	MT20	5.0	6.0		
R	BMWW-t	MT20	5.0	6.0		
S	BMV1-p	MT20	3.0	6.0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
AA	23-8-4	-25	-25	---	FRONT	VERT	TOTAL	---	C1
AB	25-8-4	-25	-25	---	FRONT	VERT	TOTAL	---	C1
AC	27-8-4	-25	-25	---	FRONT	VERT	TOTAL	---	C1
AD	29-8-4	-25	-25	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

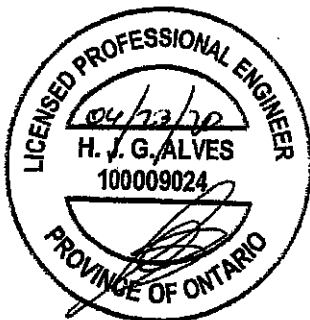

Structural component only
DWG# T-2006818

JOB NAME 408318	TRUSS NAME T2	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 23 15:32:50 2020 Page 1
 ID: HJ7_mBNWkyCmBzd_hTT?DUzjdZA-6m_PoGINLxg4RMUDJbHIIYOEMHDI_jyvGMA3zNpDR
 13-8 0-0 5-5-11 5-6-11 5-7-0 12-1-10 6-5-12 18-7-8 6-7-0 25-2-6 5-6-11 30-9-0 32-0-8 1-3-8
 Scale = 1:50.0

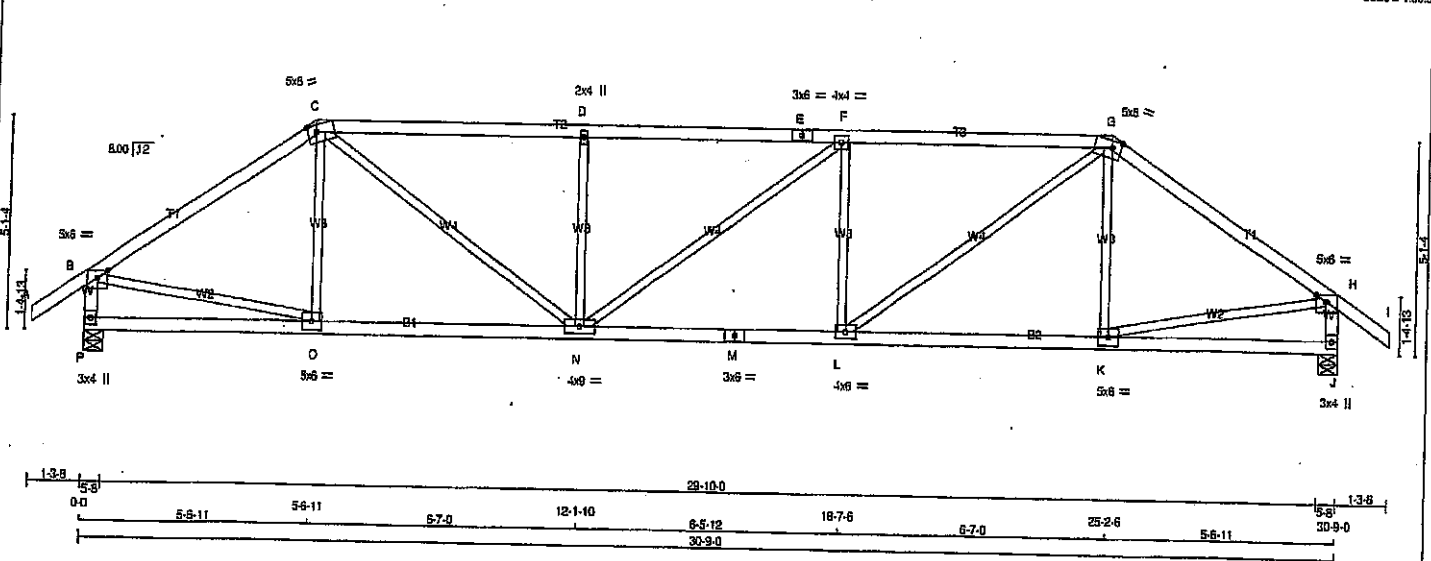

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
J - B	2x4	DRY	No.2
P - H	2x4	DRY	No.2
P - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW-p	MT20	5.0	5.0	Edge	2.00 2.75
C	TTWW-m	MT20	5.0	5.0	Edge	2.00 2.75
D	TMW-w	MT20	2.0	4.0		
E	TS-1	MT20	3.0	5.0		
F	TMW-w	MT20	4.0	4.0		
G	TTWW-m	MT20	5.0	5.0	2.00 2.75	
H	TMW-p	MT20	5.0	5.0	Edge	
J	BMV1-p	MT20	3.0	4.0		
K	BMW-w	MT20	5.0	5.0		
L	BMW-w	MT20	4.0	5.0		
M	BS-1	MT20	3.0	5.0		
N	BMW-w	MT20	4.0	5.0		
O	BMW-w	MT20	5.0	5.0		
P	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	1821	1821	0	5-8
P VERT	1821	1821	0	5-8
JT HORZ	0	0	0	5-8
P HORZ	0	0	0	5-8

UNFACTORED REACTIONS

	1ST LOOSE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	1285	857 / 0
P COMBINED	1285	857 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.42 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (LBS)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
A-B	0 / 35	-91.8	-91.8 0.12 (1)	O-C	-164 / 33
B-C	-1958 / 0	-91.8	-91.8 0.65 (1)	C-N	0 / 1302
C-D	-2673 / 0	-91.8	-91.8 0.80 (1)	N-D	-650 / 0
D-E	-2676 / 0	-91.8	-91.8 0.80 (1)	N-F	-2 / 0
E-F	-2676 / 0	-91.8	-91.8 0.80 (1)	F-G	-650 / 0
F-G	-2677 / 0	-91.8	-91.8 0.81 (1)	L-G	0 / 1304
G-H	-1958 / 0	-91.8	-91.8 0.65 (1)	K-G	-185 / 33
H-I	0 / 35	-91.8	-91.8 0.12 (1)	B-O	0 / 1657
P-B	-1760 / 0	0.0	0.0 0.18 (1)	K-H	0 / 1655
J-H	-1760 / 0	0.0	0.0 0.18 (1)		
P-O	0 / 0	-18.5	-18.5 0.16 (4)		
O-N	0 / 1623	-18.5	-18.5 0.35 (1)		
N-M	0 / 2677	-18.5	-18.5 0.50 (1)		
M-L	0 / 2677	-18.5	-18.5 0.50 (1)		
L-K	0 / 1623	-18.5	-18.5 0.35 (1)		
K-J	0 / 0	-18.5	-18.5 0.16 (4)		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA D86-09, CSA D86-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
 CALCULATED VERT. DEFL.(LL) = 1/999 (0.13")
 ALLOWABLE DEFL.(TL) = L/360 (1.03")
 CALCULATED VERT. DEFL.(TL) = 1/999 (0.26")

CSI: TC=0.81/1.00 (F-G:1), BC=0.50/1.00 (L-N:1),
 WB=0.37/1.00 (B-C:1), SS=0.26/1.00 (F-G:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1667 788 1987 1656	

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.88 (G) (INPUT = 0.90)
 JSI METAL = 0.87 (M) (INPUT = 1.00)

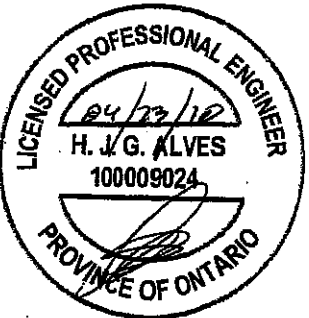

Structural component only
 DWG# T-2006819

JOB NAME 408318	TRUSS NAME T2X	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 23 15:32:51 2020 Page 1	
ID:HJ7_mBNWkyCmBzl_hTT?DUzjdZA-azYo0sJ76F0x2fwgm1jWqzPuehJyJqsAZ?v7VzNp0Q				30-9-0 31-5-0 32-0-8 5-0-7-8 Scale = 1:51.7	

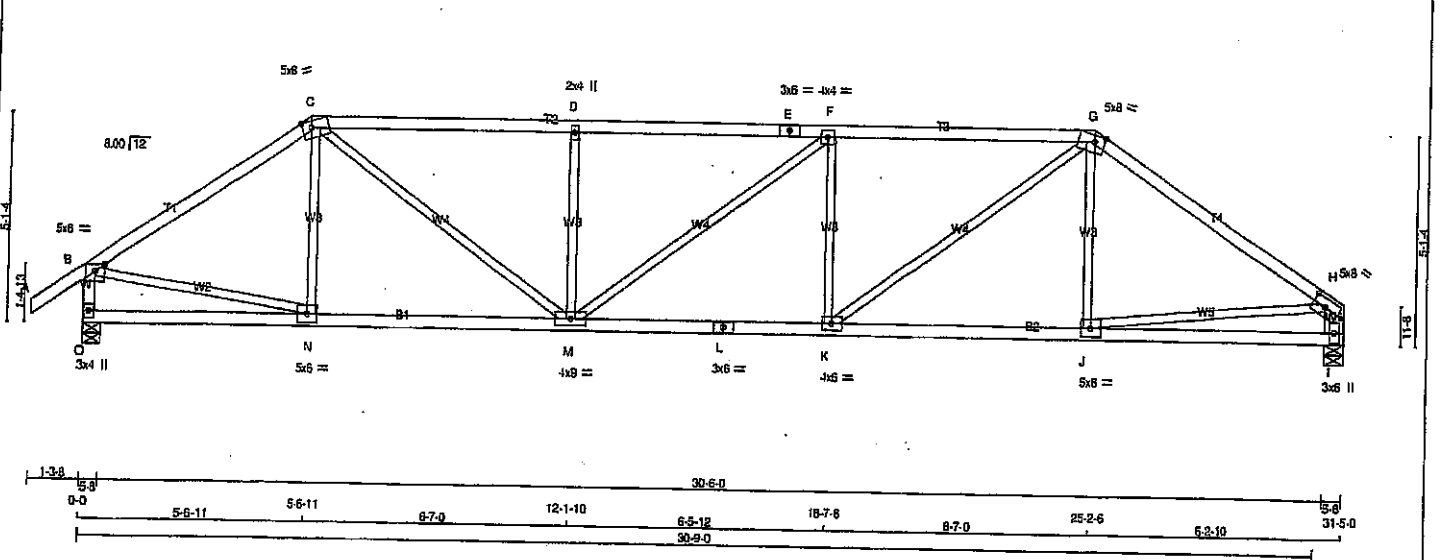

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
O - B	2x4	DRY	No.2
O - L	2x4	DRY	No.2
L - I	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
I - H	2x6	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0	5.0 Edge
C	TTWW-m	MT20	5.0	8.0 2.00 2.75
D	TMVW-w	MT20	2.0	4.0
E	TS-I	MT20	3.0	6.0
F	TMVW-I	MT20	4.0	4.0
G	TTWW-m	MT20	5.0	8.0 2.00 3.00
H	TMVW-I	MT20	5.0	8.0 2.50 3.75
I	BMVW-I	MT20	3.0	6.0
J	BMVW-I	MT20	5.0	6.0
K	BMVW-I	MT20	4.0	6.0
L	BS-I	MT20	3.0	6.0
M	BMVW-I	MT20	4.0	9.0
N	BMVW-I	MT20	5.0	6.0
O	BMVW-I	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
O	1845	0	1845	0	0	5-8	5-8	5-8	5-8
I	1718	0	1718	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
O	1303	888 / 0	0 / 0	0 / 0	434 / 0
I	1216	798 / 0	0 / 0	0 / 0	418 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, I.

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.38 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		MEMB.		WEBS	
MAX. FACTORED	FORCE (LBS)	MAX. FACTORED	FORCE (LBS)	MAX. FACTORED	FORCE (LBS)
FR-TO		FROM TO		FR-TO	
A-B	0 / 35	-91.8 -91.8 0.12 (1)	10.00	N-O	-189 / 31
B-C	-1992 / 0	-91.8 -91.8 0.66 (1)	4.05	C-M	0 / 1343
C-D	-2736 / 0	-91.8 -91.8 0.81 (1)	3.39	M-D	-850 / 0
D-E	-2736 / 0	-91.8 -91.8 0.81 (1)	3.38	M-F	-42 / 0
E-F	-2736 / 0	-91.8 -91.8 0.81 (1)	3.38	K-F	-828 / 0
F-G	-2770 / 0	-91.8 -91.8 0.83 (1)	3.38	J-G	0 / 1281
G-H	-2109 / 0	-91.8 -91.8 0.81 (1)	3.77	J-G	-96 / 68
O-B	-1804 / 0	0.0 0.0 0.19 (1)	6.23	B-N	0 / 1685
				J-H	0 / 1767
				I-H	-1874 / 0
O-N	0 / 0	-18.5 -18.5 0.18 (4)	10.00		
N-M	0 / 1651	-18.5 -18.5 0.35 (1)	10.00		
M-L	0 / 2770	-18.5 -18.5 0.51 (1)	10.00		
L-K	0 / 2770	-18.5 -18.5 0.51 (1)	10.00		
K-J	0 / 1751	-18.5 -18.5 0.38 (1)	10.00		
J-I	0 / 0	-18.5 -18.5 0.17 (4)	10.00		

TOTAL WEIGHT = 121 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OSC 2012, ABC 2019
- PART 9 OF OSC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.04")
CALCULATED VERT. DEFL. (LL) = L/999 (0.14")
ALLOWABLE DEFL. (TL) = L/360 (1.04")
CALCULATED VERT. DEFL. (TL) = L/989 (0.26")

CSI: TC=0.83/1.00 (F-G:1), BC=0.51/1.00 (K-M:1),
WB=0.40/1.00 (H-J:1), SS=0.28/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1655

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.90 (C) (INPUT = 0.90)
JSI METAL=0.90 (L) (INPUT = 1.00)



Structural component only
DWG# T-2006820

JOB NAME 408318	TRUSS NAME T3	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
Turnerack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 15:32:53 2020 Page 1 ID:HJ7_mBNWkyCmBzI_hTT?DUzjdZA-XLgYRILFes2fly43uSL_wOV8PSPMQ6W9eUJ0BNzNp00 30-9-0 32-0-8 1-3-8 Scale = 1:50.9		

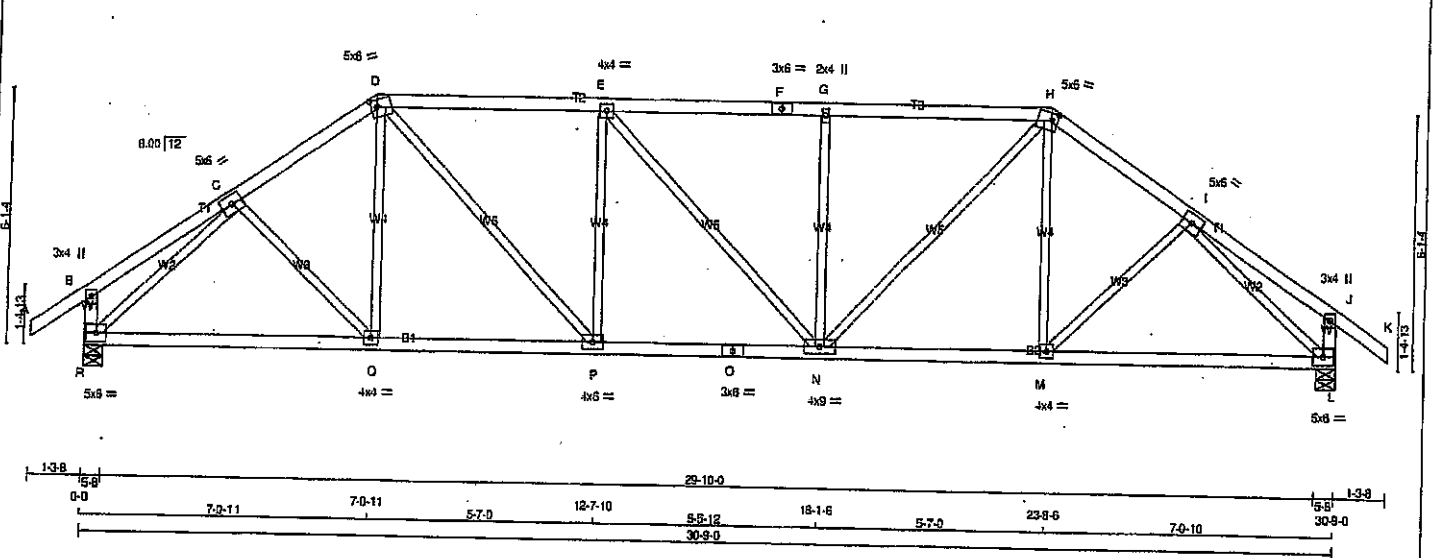

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - H	2x4	DRY No.2	SPF
H - K	2x4	DRY No.2	SPF
R - B	2x4	DRY No.2	SPF
L - J	2x4	DRY No.2	SPF
R - O	2x4	DRY No.2	SPF
O - L	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV-p	MT20	3.0	4.0
C	TMVW-1	MT20	5.0	6.0
D	TTWW-m	MT20	5.0	6.0
E	TMVW-1	MT20	4.0	4.0
F	TS-1	MT20	3.0	6.0
G	TMVW-m	MT20	2.0	4.0
H	TTWW-m	MT20	5.0	6.0
I	TMVW-1	MT20	3.0	4.0
J	TMV-p	MT20	5.0	6.0
L	BMVW-1	MT20	5.0	6.0
M	BMVW-1	MT20	4.0	4.0
N	BMVW-1	MT20	4.0	4.0
O	BS-1	MT20	4.0	6.0
P	BMVW-1	MT20	4.0	6.0
Q	BMVW-1	MT20	4.0	4.0
R	BMVW-1	MT20	5.0	6.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
R	1821	0	1821	0	0	5-8	5-8
L	1821	0	1821	0	0	5-8	5-8

UNFACTORED REACTIONS		1ST LOASE		MAX/MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
R	1285	857.0	0.0	0.0	0.0
L	1285	857.0	0.0	0.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.08 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO	
A-B	0.735	-91.8	-91.8 0.12 (1)	Q-D	0.771
B-C	0.718	-91.8	-91.8 0.16 (1)	Q-D	0.7106
C-D	-1948.0	-91.8	-91.8 0.22 (1)	D-P	0.7892
D-E	-2223.0	-91.8	-91.8 0.50 (1)	P-E	-549.0
E-F	-2221.0	-91.8	-91.8 0.50 (1)	E-N	-2.0
F-G	-2221.0	-91.8	-91.8 0.50 (1)	N-G	-549.0
G-H	-2221.0	-91.8	-91.8 0.50 (1)	H-N	0.7889
H-I	-1948.0	-91.8	-91.8 0.22 (1)	M-H	0.7106
I-J	0.718	-91.8	-91.8 0.16 (1)	M-I	0.71
J-K	0.735	-91.8	-91.8 0.12 (1)	R-C	-2167.0
R-B	-254.0	0.0	0.0 0.03 (1)	I-L	-2168.0
L-J	-254.0	0.0	0.0 0.03 (1)		
R-Q	0.1553	-18.5	-18.5 0.36 (1)		
C-P	0.1605	-18.5	-18.5 0.37 (1)		
P-O	0.2223	-18.5	-18.5 0.41 (1)		
O-N	0.2223	-18.5	-18.5 0.41 (1)		
N-M	0.1605	-18.5	-18.5 0.37 (1)		
M-L	0.1553	-18.5	-18.5 0.36 (1)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.02")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.02")
CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CSI: TC=0.50/1.00 (D-E-1), BC=0.41/1.00 (N-P-1), WB=0.83/1.00 (I-L-1), SS=0.24/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.88 (I) (INPUT = 0.90)
JSI METAL = 0.73 (O) (INPUT = 1.00)



Structural component only
DWG# T-2006821

JOB NAME 408318	TRUSS NAME T4	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 23 15:32:54 2020 Page 1
ID:HJ7_mBNWkyOmBzl_hTT?DUzjdZA-?XDwleLiPAAWv8lFS9sDSb1HDnk9cHtXEakqzNp0N
Scale = 1:80.9

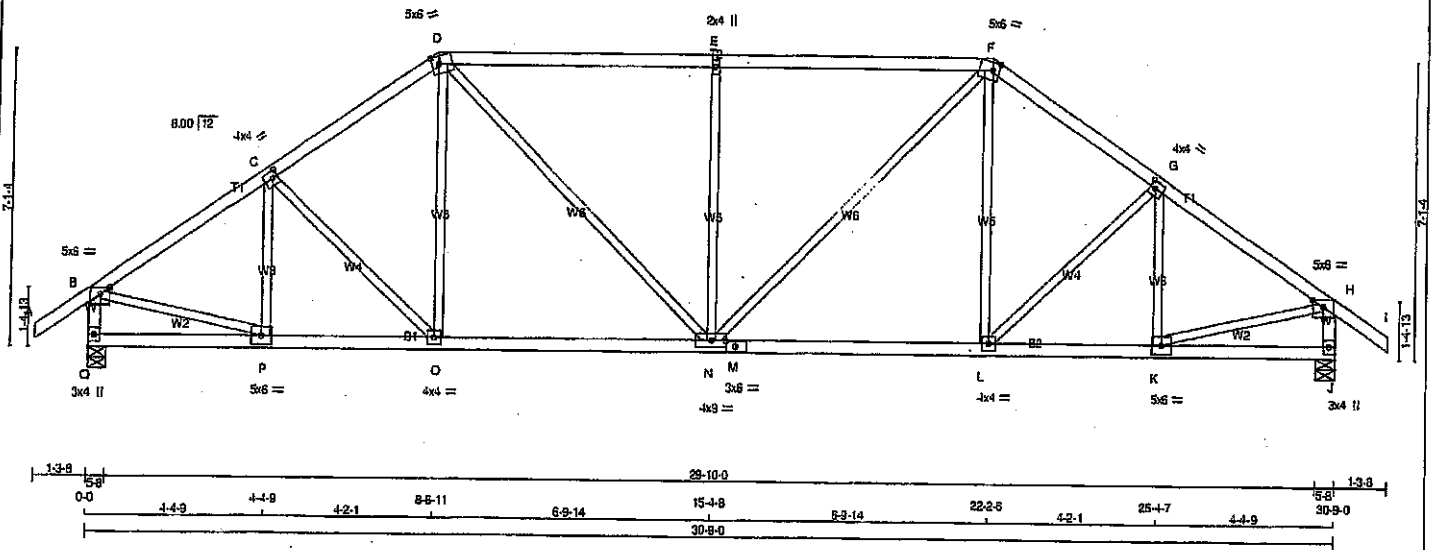

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
Q - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
Q - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY; SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	6.0	Edge
C	TMVW-i	MT20	4.0	4.0	2.00 1.50
D	TTVW-m	MT20	5.0	6.0	2.25 2.00
E	TMVW-w	MT20	2.0	4.0	
F	TTVW-m	MT20	5.0	6.0	2.25 2.00
G	TMVW-i	MT20	4.0	4.0	2.00 1.50
H	TMVW-p	MT20	5.0	6.0	Edge
J	BMV1-p	MT20	3.0	4.0	
K	BMVW-i	MT20	5.0	6.0	
L	BMVW-i	MT20	4.0	4.0	
M	BS-i	MT20	3.0	6.0	1.50 2.75
N	BMVW-i	MT20	4.0	4.0	
O	BMVW-i	MT20	4.0	4.0	
P	BMVW-i	MT20	5.0	6.0	
Q	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
Q	1821	0	1821	0	0	5-8	5-8
J	1821	0	1821	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LOASE		MAX. MIN. COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	COMBINED	SNOW	LIVE	PERM. LIVE
Q	1285	857.0	0.0	0.0	0.0	428.0	0.0	1285	857.0	0.0	0.0
J	1285	857.0	0.0	0.0	0.0	428.0	0.0	1285	857.0	0.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLINE SPACING = 4.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (LBS)	MAX. CSI (LC)	MEMB.	MAX. FORCE (LBS)	MAX. CSI (LC)	MAX. CSI (LC)
FR-TO				FR-TO			
A-B	0.35	-91.8	-91.8 0.12 (1)	10.00	P-C	-332.0	0.09 (1)
B-C	-1950.0	-91.8	-91.8 0.25 (1)	4.60	C-D	-133.0	0.08 (1)
C-D	-1886.0	-91.8	-91.8 0.25 (1)	4.67	D-E	0.201	0.05 (4)
D-E	-1989.0	-91.8	-91.8 0.53 (1)	4.03	E-F	0.635	0.14 (1)
E-F	-1989.0	-91.8	-91.8 0.53 (1)	4.03	F-G	-769.0	0.67 (1)
F-G	-1886.0	-91.8	-91.8 0.25 (1)	4.67	G-H	0.635	0.14 (1)
G-H	-1950.0	-91.8	-91.8 0.25 (1)	4.60	H-I	0.201	0.05 (4)
H-I	0.35	-91.8	-91.8 0.12 (1)	10.00	I-J	-133.0	0.08 (1)
I-J	-1783.0	0.0	0.0 0.18 (1)	6.28	J-K	-332.0	0.09 (1)
J-K	-1783.0	0.0	0.0 0.18 (1)	6.28	K-L	0.1692	0.38 (1)
K-L	0.0	-18.5	-18.5 0.08 (4)	10.00	L-M	0.1692	0.38 (1)
L-M	0.0	-18.5	-18.5 0.08 (4)	10.00	M-N	0.1692	0.38 (1)
M-N	0.0	-18.5	-18.5 0.08 (4)	10.00	N-O	0.1692	0.38 (1)
N-O	0.0	-18.5	-18.5 0.08 (4)	10.00	O-P	0.1692	0.38 (1)
O-P	0.0	-18.5	-18.5 0.08 (4)	10.00	P-Q	0.1692	0.38 (1)
P-Q	0.0	-18.5	-18.5 0.08 (4)	10.00	Q-R	0.1692	0.38 (1)
Q-R	0.0	-18.5	-18.5 0.08 (4)	10.00	R-S	0.1692	0.38 (1)
R-S	0.0	-18.5	-18.5 0.08 (4)	10.00	S-T	0.1692	0.38 (1)
S-T	0.0	-18.5	-18.5 0.08 (4)	10.00	T-U	0.1692	0.38 (1)
T-U	0.0	-18.5	-18.5 0.08 (4)	10.00	U-V	0.1692	0.38 (1)
U-V	0.0	-18.5	-18.5 0.08 (4)	10.00	V-W	0.1692	0.38 (1)
V-W	0.0	-18.5	-18.5 0.08 (4)	10.00	W-X	0.1692	0.38 (1)
W-X	0.0	-18.5	-18.5 0.08 (4)	10.00	X-Y	0.1692	0.38 (1)
X-Y	0.0	-18.5	-18.5 0.08 (4)	10.00	Y-Z	0.1692	0.38 (1)
Y-Z	0.0	-18.5	-18.5 0.08 (4)	10.00	Z-A	0.1692	0.38 (1)
Z-A	0.0	-18.5	-18.5 0.08 (4)	10.00	A-B	0.1692	0.38 (1)

TOTAL WEIGHT = 2 X 133 = 266 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, NBCC 2015, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.03")
CALCULATED VERT. DEFL. (LL) = L/999 (0.08")
ALLOWABLE DEFL. (TL) = L/360 (1.03")
CALCULATED VERT. DEFL. (TL) = L/999 (0.16")

CSI: TC=0.83/1.00 (D-E:1), BC=0.34/1.00 (L-N:1), WB=0.67/1.00 (E-N:1), SSI=0.30/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1665

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.83 (B) (INPUT = 0.90)
JSI METAL= 0.52 (M) (INPUT = 1.00)



Structural component only
DWG# T-2006822

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408318	T5	3	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

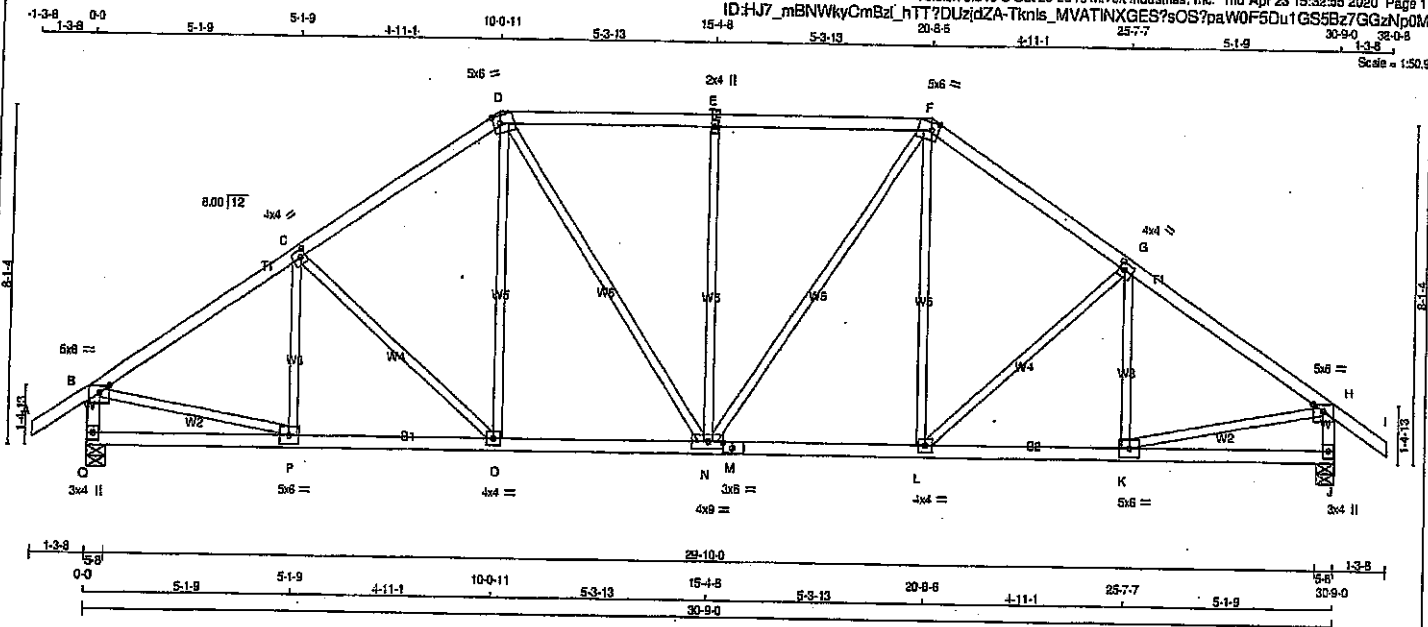

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
Q - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
Q - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge	
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TTWW-m	MT20	5.0	6.0	2.25	2.00
E	TMVW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.25	2.00
G	TMVW-w	MT20	4.0	4.0	2.00	1.50
H	TMVW-p	MT20	5.0	6.0	Edge	
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-1	MT20	5.0	6.0		
L	BMVW-1	MT20	4.0	4.0		
M	BS-t	MT20	3.0	6.0	1.50	2.75
N	BMVW-1	MT20	4.0	4.0		
O	BMVW-1	MT20	4.0	4.0		
P	BMVW-1	MT20	5.0	6.0		
Q	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	REQD BRG IN-SX
JT	VERT	HORZ		
Q	1821	0	1821	0
J	1821	0	1821	0

UNFACTORED REACTIONS

	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
Q	1285	857 / 0	0 / 0	0 / 0	0 / 0	429 / 0	0 / 0
J	1285	857 / 0	0 / 0	0 / 0	0 / 0	429 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.46 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8 -91.8 0.12 (1)	10.00	P-C	-254 / 0	0.09 (1)	
B-C	-1087 / 0	-91.8 -91.8 0.36 (1)	4.46	C-O	-275 / 0	0.23 (1)	
C-D	-1804 / 0	-91.8 -91.8 0.34 (1)	4.64	O-D	0 / 281	0.06 (1)	
D-E	-1712 / 0	-91.8 -91.8 0.37 (1)	4.69	D-N	0 / 418	0.09 (1)	
E-F	-1712 / 0	-91.8 -91.8 0.37 (1)	4.69	N-E	-595 / 0	0.75 (1)	
F-G	-1804 / 0	-91.8 -91.8 0.34 (1)	4.64	N-F	0 / 418	0.09 (1)	
G-H	-1997 / 0	-91.8 -91.8 0.36 (1)	4.46	L-F	0 / 281	0.06 (1)	
H-I	0 / 35	-91.8 -91.8 0.12 (1)	10.00	L-G	-275 / 0	0.23 (1)	
Q-B	-1780 / 0	0.0 0.0 0.18 (1)	6.28	K-G	-254 / 0	0.09 (1)	
J-H	-1780 / 0	0.0 0.0 0.18 (1)	6.28	B-P	0 / 1715	0.39 (1)	
				K-H	0 / 1715	0.39 (1)	
Q-P	0 / 0	-18.5 -18.5 0.10 (4)	10.00				
P-O	0 / 1678	-18.5 -18.5 0.32 (1)	10.00				
O-N	0 / 1477	-18.5 -18.5 0.29 (1)	10.00				
N-M	0 / 1477	-18.5 -18.5 0.29 (1)	10.00				
M-L	0 / 1477	-18.5 -18.5 0.29 (1)	10.00				
L-K	0 / 1678	-18.5 -18.5 0.32 (1)	10.00				
K-J	0 / 0	-18.5 -18.5 0.10 (4)	10.00				

TOTAL WEIGHT = 3 X 139 = 418 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 086-14
- TFC 2011, TFC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (1.03")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.07")
ALLOWABLE DEFL. (TL) = $L/360$ (1.03")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.14")

CSI: TC=0.37/1.00 (D-E:1), BC=0.32/1.00 (O-P:1), WB=0.75/1.00 (E-N:1), SS=0.24/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

	GRIP (DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.88 (B) (INPUT = 0.90)

JSI METAL= 0.44 (M) (INPUT = 1.00)



Structural component only
DWG# T-2006823

JOB NAME 408318	TRUSS NAME T6	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

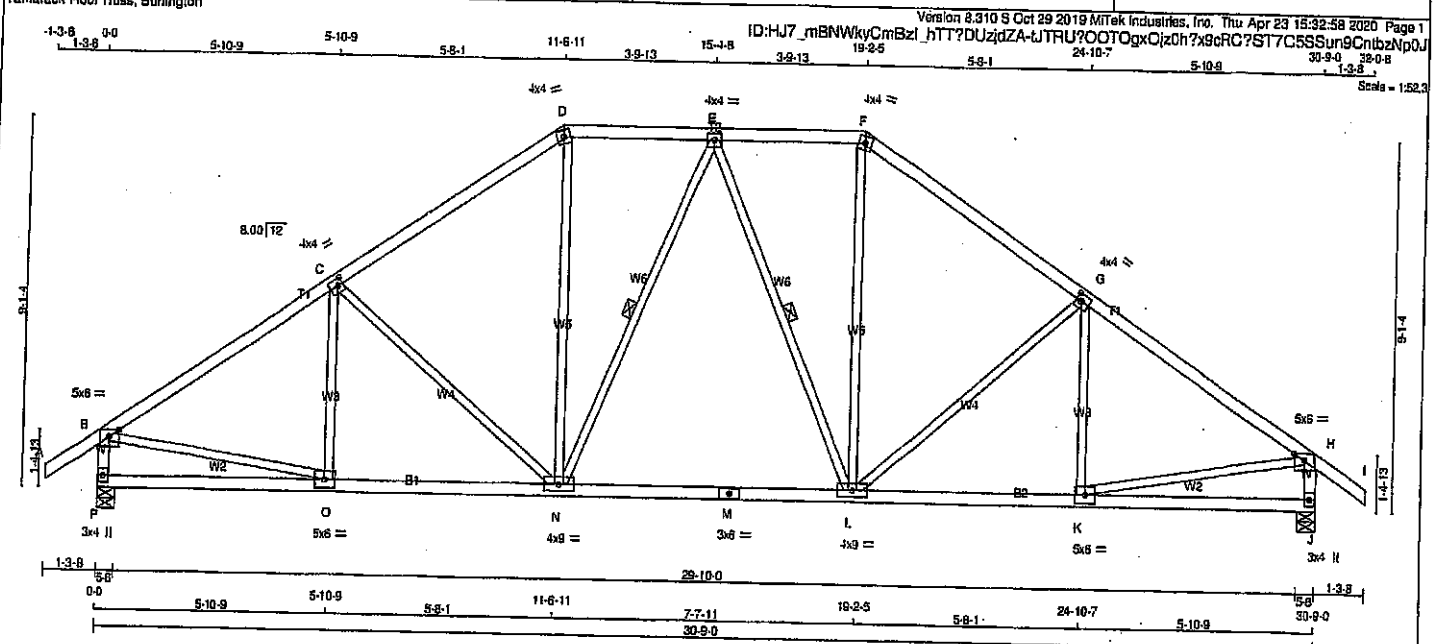

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
P - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
P - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	6.0	Edge
C	TMWW-1	MT20	4.0	4.0	2.00 1.50
D	TTW-m	MT20	4.0	4.0	
E	TMWW-1	MT20	4.0	4.0	
F	TTW-m	MT20	4.0	4.0	
G	TMWW-1	MT20	4.0	4.0	2.00 1.50
H	TMVW-p	MT20	5.0	6.0	Edge
J	BMV1-p	MT20	3.0	4.0	
K	BMWW-1	MT20	5.0	6.0	
L	BMWW-1	MT20	4.0	4.0	
M	BS-1	MT20	3.0	6.0	
N	BMWW-1	MT20	4.0	4.0	
O	BMWW-1	MT20	5.0	6.0	
P	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	GROSS REACTION	GROSS REACTION	DOWN	UPLIFT	BRG
P	1821 0	1821 0	0	5-8	5-8
J	1821 0	1821 0	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LOSE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
P	COMBINED	1285	857 0	0 0	0 0	0 0	429 0	0 0
J	COMBINED	1285	857 0	0 0	0 0	0 0	429 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.29 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N, E-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO			
A-B	0 35	-91.8 -91.8 0.12 (1)	10.00
B-C	-2002 0	-91.8 -91.8 0.48 (1)	4.29
C-D	-1713 0	-91.8 -91.8 0.45 (1)	4.60
D-E	-1401 0	-91.8 -91.8 0.18 (1)	5.33
E-F	-1401 0	-91.8 -91.8 0.18 (1)	5.33
F-G	-1713 0	-91.8 -91.8 0.45 (1)	4.60
G-H	-2002 0	-91.8 -91.8 0.48 (1)	4.29
H-I	0 35	-91.8 -91.8 0.12 (1)	10.00
P-B	-1774 0	0 0 0.18 (1)	6.27
J-H	-1774 0	0 0 0.18 (1)	6.27
P-O	0 0	-18.5 -18.5 0.13 (4)	10.00
O-N	0 1694	-18.5 -18.5 0.37 (1)	10.00
N-M	0 1489	-18.5 -18.5 0.34 (1)	10.00
M-L	0 1489	-18.5 -18.5 0.34 (1)	10.00
L-K	0 1694	-18.5 -18.5 0.37 (1)	10.00
K-J	0 0	-18.5 -18.5 0.13 (4)	10.00

TOTAL WEIGHT = 2 X 139 = 278 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(85 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (1.03')
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.07')
ALLOWABLE DEFL. (TL) = $L/360$ (1.03')
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.17')

CSI: TC=0.48/1.00 (B-C:1), BC=0.37/1.00 (N-O:1), WB=0.47/1.00 (C-N:1), SL=0.22/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.87 (H) (INPUT = 0.90)
JSI METAL= 0.58 (M) (INPUT = 1.00)



Structural component only
DWG# T-2006825

Version 8.310.5 Oct 29 2019 MITek Industries, Inc. Thu Apr 23 20:17:38 2020 Page 1

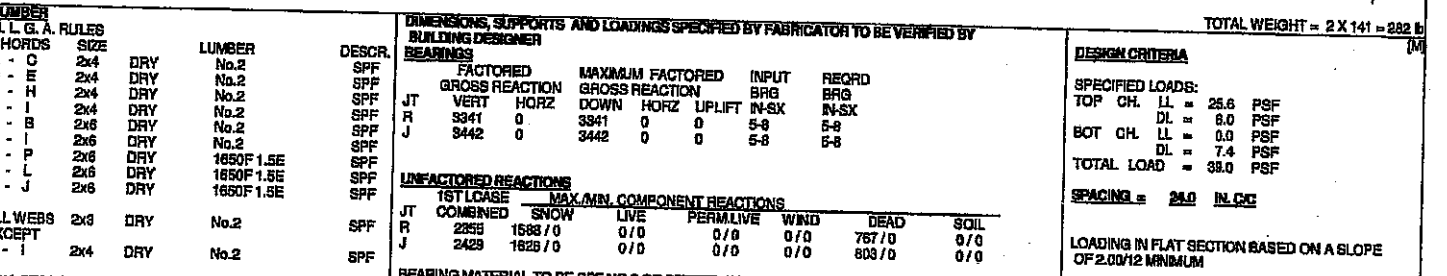[illegible]

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 33.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.05")
CALCULATED VERT. DEFL.(LL) = L/999 (0.27")
ALLOWABLE DEFL.(TL) = L/360 (1.05")
CALCULATED VERT. DEFL.(TL) = L/763 (0.49")

CSH: TC=0.88/1.00 (F-G:1), BC=0.68/1.00 (M-N:1),
WB=0.62/1.00 (H-M:1), SS=0.29/1.00 (M-N:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVEHEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 778 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.50 (C) (INPUT = 0.90)
JSI METAL= 0.53 (M) (INPUT = 1.00)

CONTINUED ON PAGE 2

JOB NAME 408318	TRUSS NAME T7X	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 20:17:34 2020 Page 2
ID:HJ7 mBNWkyCmBzI hTT?DUzkdZA-uSGINu2Z2?430xOu0GIXIQ83v381MM/KPrMCrZNkrV


PLATES (Table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.50	3.00
C	TTWW-m	MT20	6.0	9.0	1.75	3.75
D	TMVW-t	MT20	5.0	6.0		
E	TS-t	MT20	3.0	8.0		
F	TMVW-w	MT20	2.0	4.0		
G	TMVW-t	MT20	4.0	6.0		
H	TTWW-m	MT20	6.0	9.0	1.75	3.25
I						
J	TMBMVW1-p	MT20	7.0	12.0	10.00	9.25
K	BMVW-t	MT20	5.0	6.0		
L	BS-t	MT20	5.0	6.0		
M	BMVW-t	MT20	5.0	8.0	2.50	2.00
N	BMVWVW-t	MT20	5.0	8.0	2.50	3.00
O	BMVW-t	MT20	5.0	6.0	2.50	2.50
P	BS-t	MT20	5.0	6.0		
Q	BMVW-t	MT20	5.0	6.0		
R	BMV1-p	MT20	3.0	6.0		



Structural component only
DWG# T-2008828 7/2

JOB NAME 408318	TRUSS NAME T8	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 6.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 15:33:00 2020 Page 1
ID: HJ7_mBNWkyCmBzI_hTT?DUzjdZA-phbBvhQe?0wld16PoQzdlisHOrGqQZivBFSshuxUzNp0H
13-4-12 18-0-0 19-3-8
Scale = 1/4"=1'-0"

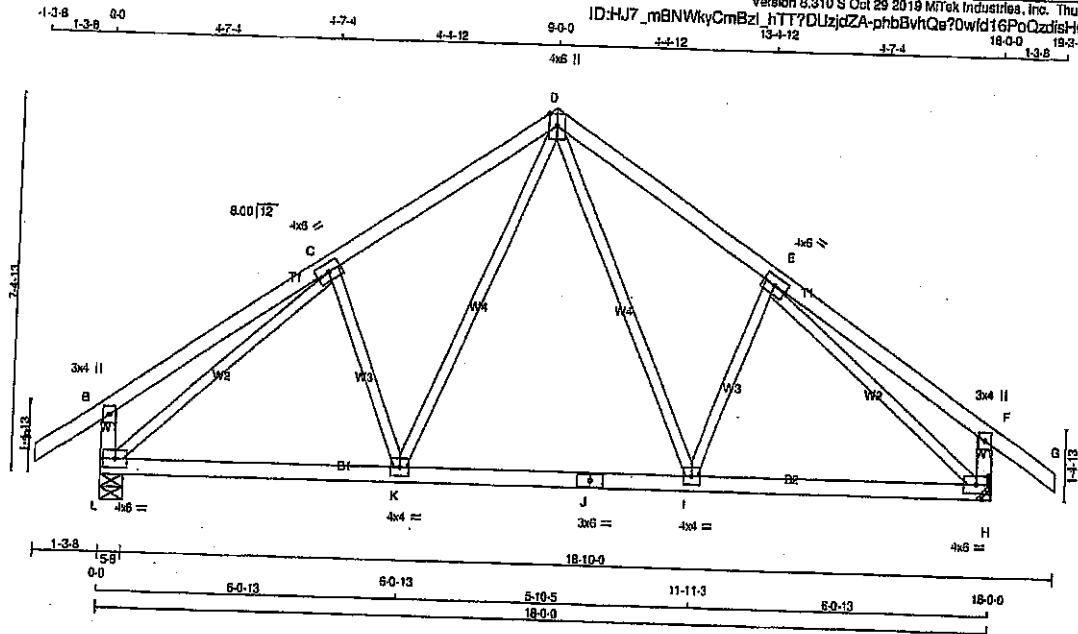

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-i	MT20	4.0	8.0		
D	TTWW+p	MT20	4.0	8.0		Edge
E	TMWW-i	MT20	4.0	8.0		
F	TMV+p	MT20	3.0	4.0		
H	BMVW1-i	MT20	4.0	6.0		
I	BMVW1-i	MT20	4.0	4.0		
J	BS-i	MT20	3.0	6.0		
K	BMVW1-i	MT20	4.0	4.0		
L	BMVW1-i	MT20	4.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	IN-SX	IN-SX
L 1118	0	0	5-8
H 1118	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

1ST CASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
JT COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
L 788	531.0	0.0	0.0	0.0	258.0
H 788	531.0	0.0	0.0	0.0	258.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.05 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0.35	-91.8	-91.8 0.12 (1)	10.00	D-I	0.387	0.09 (1)
B-C	0.27	-91.8	-91.8 0.30 (1)	10.00	E	-255.0	0.08 (1)
C-D	-959.0	-91.8	-91.8 0.24 (1)	6.05	K-D	0.387	0.09 (1)
D-E	-959.0	-91.8	-91.8 0.24 (1)	6.05	C-K	-255.0	0.08 (1)
E-F	0.27	-91.8	-91.8 0.30 (1)	10.00	L-C	-1174.0	0.73 (1)
F-G	0.35	-91.8	-91.8 0.12 (1)	10.00	E-H	-1174.0	0.73 (1)
L-B	-283.0	0.0	0.0 0.03 (1)	7.81			
H-F	-283.0	0.0	0.0 0.03 (1)	7.81			
L-K	0.859	-18.5	-18.5 0.22 (4)	10.00			
K-J	0.828	-18.5	-18.5 0.20 (4)	10.00			
J-I	0.828	-18.5	-18.5 0.20 (4)	10.00			
I-H	0.859	-18.5	-18.5 0.22 (4)	10.00			

TOTAL WEIGHT = 2 X 79 = 159 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.60")
CALCULATED VERT. DEFL. (LL) = L/999 (0.03")
ALLOWABLE DEFL. (TL) = L/360 (0.60")
CALCULATED VERT. DEFL. (TL) = L/999 (0.06")

CSI: TC=0.30/1.00 (B-C-1), BC=0.22/1.00 (K-L-4), WB=0.73/1.00 (C-L-1), SSI=0.17/1.00 (G-D-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	618	354	1687 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.82 (E) (INPUT = 0.90)
JSI METAL= 0.30 (C) (INPUT = 1.00)



Structural component only
DWG# T-2006827

JOB NAME 408318	TRUSS NAME T8G	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 23 15:33:01 2020 Page 1	

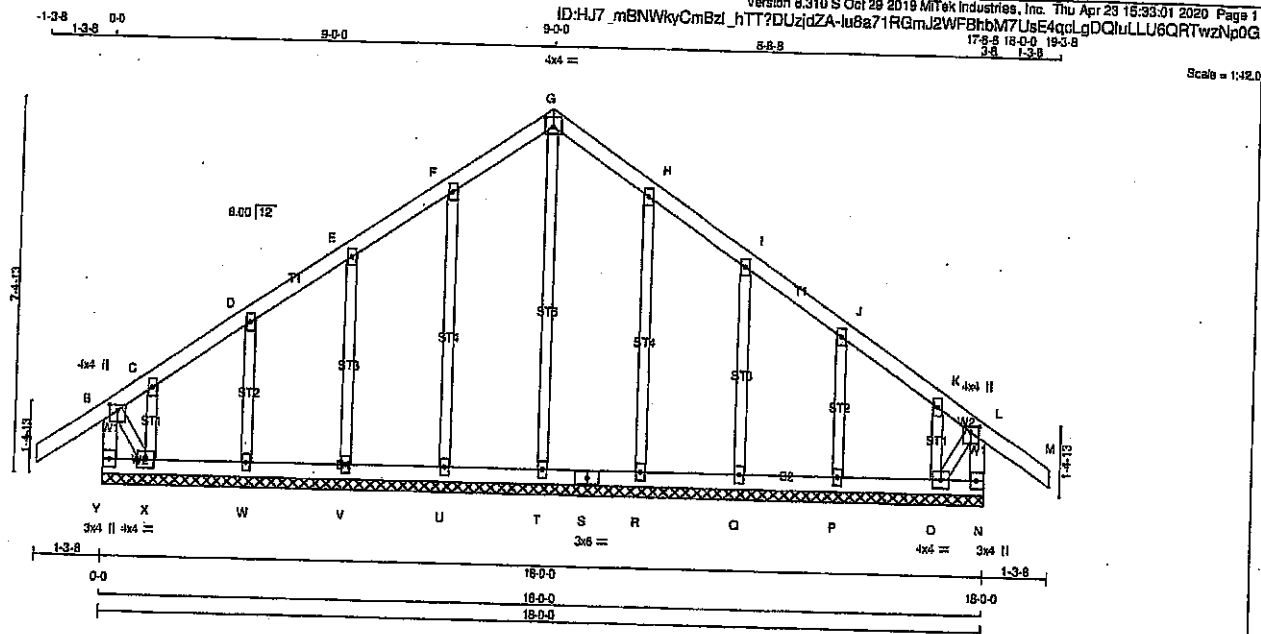

LUMBER			
N, L, G, A, RULES	CHORDS	SIZE	LUMBER
Y - B	2x4	DRY	No.2
A - G	2x4	DRY	No.2
G - M	2x4	DRY	No.2
N - L	2x4	DRY	No.2
Y - S	2x4	DRY	No.2
S - N	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			
GABLE STUDS SPACED AT 2'-0" OC.			

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMW+p	MT20	4.0	4.0	1.25 2.00
C, D, E, F, H, I, J, K				
C TMW+w	MT20	2.0	4.0	
G TTW+p	MT20	4.0	4.0	2.25 2.00
L TMW+p	MT20	4.0	4.0	1.25 2.00
N BMW1+p	MT20	3.0	4.0	
O BMW1+1	MT20	4.0	4.0	
P, Q, R, T, U, V, W				
P BMW1+w	MT20	2.0	4.0	
S BS-1	MT20	3.0	5.0	
X BMW1+1	MT20	4.0	4.0	
Y BMW1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)
BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO			
Y-B	-282 / 0	0.0	0.03 (1)	T-G	-145 / 0	0.14 (1)	
A-B	0 / 35	-91.8	-91.8 0.12 (1)	U-F	-209 / 0	0.12 (1)	
B-C	-68 / 0	-91.8	-91.8 0.12 (1)	V-E	-173 / 0	0.08 (1)	
C-D	-15 / 0	-91.8	-91.8 0.05 (1)	W-D	-194 / 0	0.04 (1)	
D-E	-16 / 0	-91.8	-91.8 0.05 (1)	X-C	-41 / 0	0.01 (1)	
E-F	-8 / 0	-91.8	-91.8 0.05 (1)	R-H	-209 / 0	0.12 (1)	
F-G	-18 / 0	-91.8	-91.8 0.05 (1)	Q-I	-173 / 0	0.08 (1)	
G-H	-18 / 0	-91.8	-91.8 0.05 (1)	P-J	-194 / 0	0.04 (1)	
H-I	-8 / 0	-91.8	-91.8 0.05 (1)	O-K	-41 / 0	0.01 (1)	
I-J	-16 / 0	-91.8	-91.8 0.05 (1)	B-X	0 / 28	0.01 (1)	
J-K	-15 / 0	-91.8	-91.8 0.05 (1)	O-L	0 / 28	0.01 (1)	
K-L	-68 / 0	-91.8	-91.8 0.12 (1)				
L-M	0 / 35	-91.8	-91.8 0.12 (1)				
N-L	-282 / 0	0.0	0.03 (1)				
Y-X	0 / 0	-18.5	-18.5 0.01 (4)				
X-W	0 / 17	-18.5	-18.5 0.02 (4)				
W-V	0 / 12	-18.5	-18.5 0.02 (4)				
V-U	0 / 9	-18.5	-18.5 0.01 (4)				
U-T	0 / 6	-18.5	-18.5 0.01 (4)				
T-S	0 / 6	-18.5	-18.5 0.01 (4)				
S-R	0 / 6	-18.5	-18.5 0.01 (4)				
R-Q	0 / 9	-18.5	-18.5 0.01 (4)				
Q-P	0 / 12	-18.5	-18.5 0.02 (4)				
P-O	0 / 17	-18.5	-18.5 0.02 (4)				
O-N	0 / 0	-18.5	-18.5 0.01 (4)				

TOTAL WEIGHT = 81 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (L-M:1), BC=0.02/1.00 (O-P:4),
WB=0.14/1.00 (G-T:1), SS=0.08/1.00 (L-M:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENG=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1668

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.48 (X) (INPUT = 0.90)
JSI METAL= 0.11 (F) (INPUT = 1.00)



Structural component only
DWG# T-2006828

JOB NAME 408318	TRUSS NAME T9	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 15:33:03 2020 Page 1
 ID:HJ7_mBNWkyCmBzl_hTT?DUzjdZA-EGGKXJSXkJEUVr_TYXGJWvL-UqKmk6exQvYYozNp0E
 Scale = 1:37.2

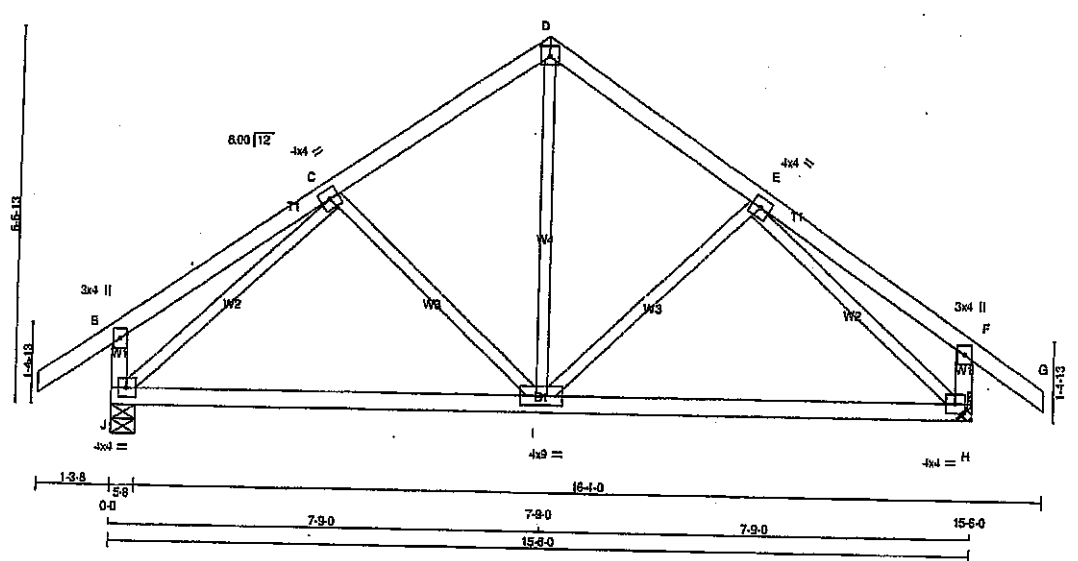

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2		
D - G	2x4	DRY	No.2		
J - B	2x4	DRY	No.2		
H - F	2x4	DRY	No.2		
J - H	2x4	DRY	No.2		

ALL WEBS 2x3 DRY No.2
 EXCEPT
 DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE	FLATES			
B	TMV+p	MT20	3.0	4.0
C	TMVW+1	MT20	4.0	4.0
D	TTW+p	MT20	4.0	4.0
E	TMVW+1	MT20	4.0	4.0
F	TMV+p	MT20	3.0	4.0
H	BMVW1+1	MT20	4.0	4.0
I	BMVW+1	MT20	4.0	4.0
J	BMVW1+1	MT20	4.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
J	980	0	980	0
H	980	0	980	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3.8.

UNFACTORED REACTIONS							
1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	691	467.0	0.0	0.0	0.0	224.0	0.0
H	691	467.0	0.0	0.0	0.0	224.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM	TO			FR-TO			
A-B	0.35	-91.8	-91.8	0.12 (1)	10.00	I-D	0.480	0.10 (1)	
B-C	0.23	-91.8	-91.8	0.22 (1)	10.00	I-E	-208.0	0.10 (1)	
C-D	-685.0	-91.8	-91.8	0.17 (1)	8.25	C-I	-208.0	0.10 (1)	
D-E	-685.0	-91.8	-91.8	0.17 (1)	8.25	J-C	-965.0	0.44 (1)	
E-F	0.23	-91.8	-91.8	0.22 (1)	10.00	E-H	-965.0	0.44 (1)	
F-G	0.35	-91.8	-91.8	0.12 (1)	10.00				
J-B	-262.0	0.0	0.0	0.03 (1)	7.81				
H-F	-262.0	0.0	0.0	0.03 (1)	7.81				
J-I	0.701	-18.5	-18.5	0.37 (4)	10.00				
I-H	0.701	-18.5	-18.5	0.37 (4)	10.00				

TOTAL WEIGHT = 2 X 66 = 132 lb

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-08, CSA 086-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.52")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
 ALLOWABLE DEFL.(TL) = L/360 (0.52")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.09")

CSI: TC=0.22/1.00 (B-C:1), BC=0.37/1.00 (H-I:4),
 WB=0.44/1.00 (C-J:1), SSI=0.14/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1997 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.81 (H) (INPUT = 0.90)
 JSI METAL = 0.34 (C) (INPUT = 1.00)



Structural component only
 DWG# T-2008829

JOB NAME 408318	TRUSS NAME T9S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
Tamarack Roof Truss, Burlington						

Version 8.310 9 Oct 2019 MTek Industries, Inc. Thu Apr 23 15:33:04 2020 Page 1
ID: HJ7_mBNWkyCmBzI_hTT?DUzjdZA-ITqI3T92ER56aQA1F2Zs4ZiCZVERnA4154FzNp0D

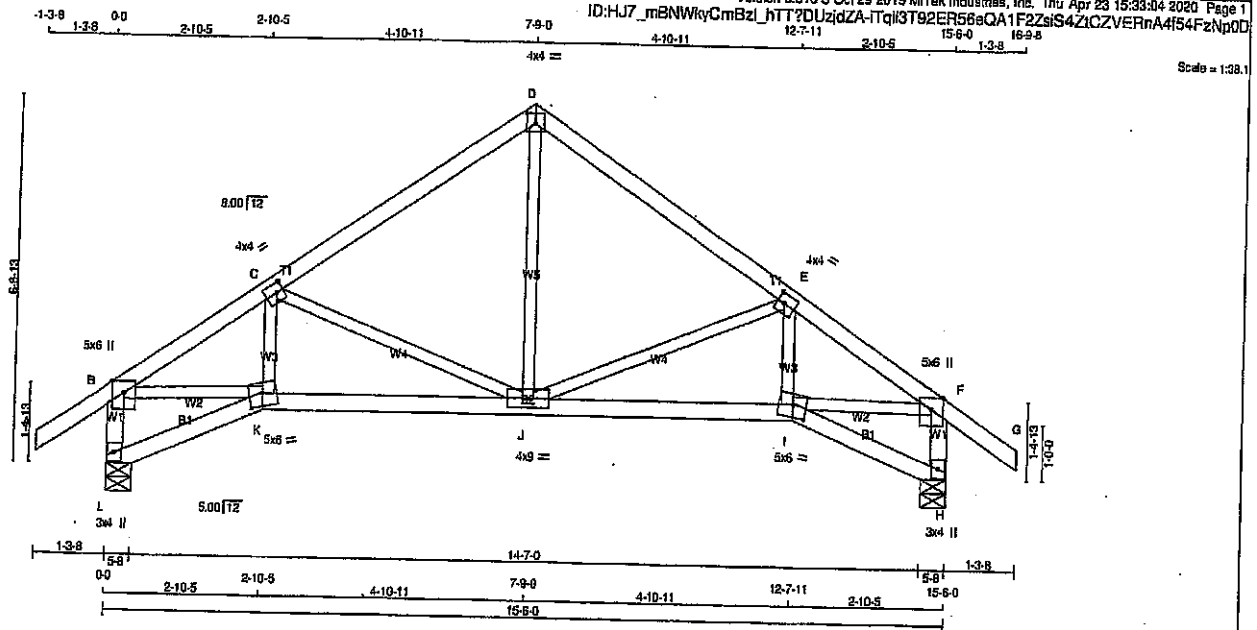

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	5.0	6.0	Edge	
O	TMWW-i	MT20	4.0	4.0	2.00	1.50
D	TTV-p	MT20	4.0	4.0	2.25	2.00
E	TMWW-i	MT20	4.0	4.0	2.00	1.50
F	TMWW-p	MT20	5.0	6.0	Edge	
H	BMV1-p	MT20	3.0	4.0		
J	BBWW-m	MT20	5.0	6.0	2.75	3.00
I	BBWW-i	MT20	4.0	9.0		
K	BBWW-m	MT20	5.0	6.0	2.75	3.00
L	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
L	980 0	980 0	5-8	5-8
H	980 0	980 0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	691	467 / 0	0 / 0	0 / 0	0 / 0	224 / 0	0 / 0
H	691	467 / 0	0 / 0	0 / 0	0 / 0	224 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.49 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 35	-91.8 -91.8	0.12 (1)	10.00	J-D	0 / 490	0.11 (1)
B-C	-1272 / 0	-91.8 -91.8	0.21 (1)	5.49	J-E	-493 / 0	0.22 (1)
C-D	-791 / 0	-91.8 -91.8	0.25 (1)	8.25	I-E	0 / 59	0.02 (4)
D-E	-791 / 0	-91.8 -91.8	0.25 (1)	6.25	C-J	-493 / 0	0.22 (1)
E-F	-1272 / 0	-91.8 -91.8	0.21 (1)	5.49	K-C	0 / 59	0.02 (4)
F-G	0 / 35	-91.8 -91.8	0.12 (1)	10.00	B-K	0 / 1087	0.24 (1)
L-B	-954 / 0	0.0 0.0	0.10 (1)	7.81	I-F	0 / 1087	0.24 (1)
H-F	-954 / 0	0.0 0.0	0.10 (1)	7.81			
L-K	0 / 0	-18.5 -18.5	0.04 (4)	10.00			
K-J	0 / 1085	-18.5 -18.5	0.24 (1)	10.00			
J-I	0 / 1085	-18.5 -18.5	0.24 (1)	10.00			
I-H	0 / 0	-18.5 -18.5	0.04 (4)	10.00			

TOTAL WEIGHT = 2 X 65 = 131 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.52")
CALCULATED VERT. DEFL. (LL) = L/999 (0.03")
ALLOWABLE DEFL. (TL) = L/360 (0.52")
CALCULATED VERT. DEFL. (TL) = L/999 (0.08")

CSI: TC=0.25/1.00 (D-E-I), BC=0.24/1.00 (J-K-I),
WB=0.24/1.00 (B-K-I), SSI=0.17/1.00 (C-D-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1667 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (B) (INPUT = 0.90)
JSI METAL = 0.92 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006830

JOB NAME 408318	TRUSS NAME T10	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

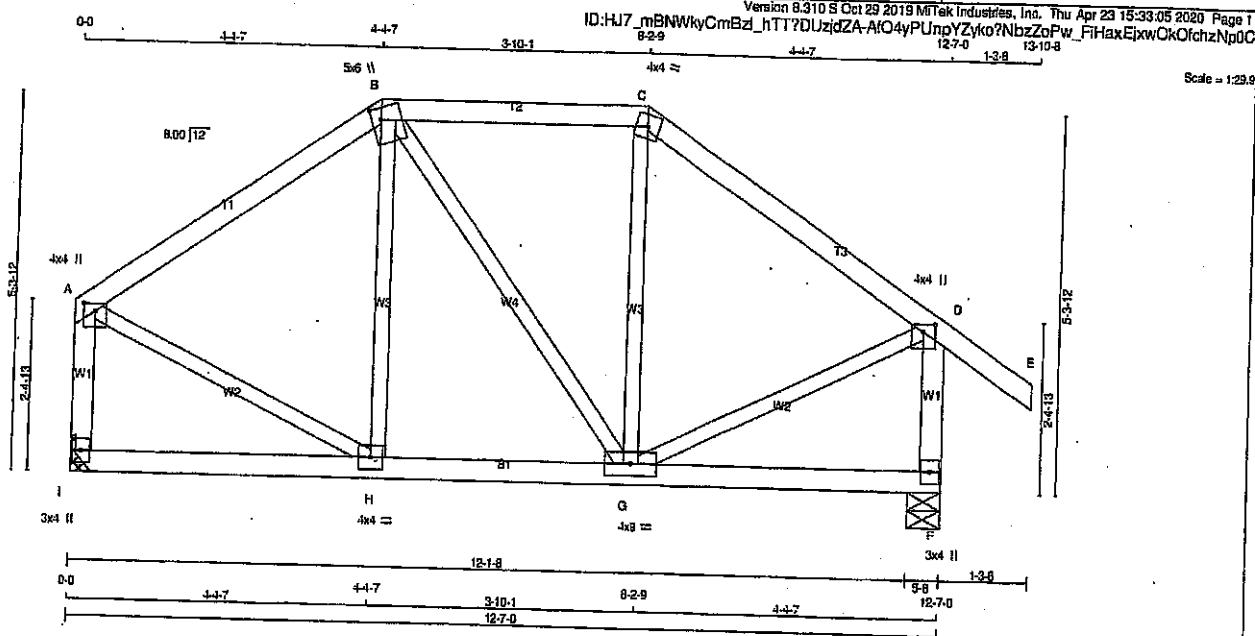

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
A - B	2x4	DRY	No.2		
B - C	2x4	DRY	No.2		
C - D	2x4	DRY	No.2		
D - E	2x4	DRY	No.2		
E - F	2x4	DRY	No.2		
F - G	2x4	DRY	No.2		
G - H	2x4	DRY	No.2		
H - I	2x4	DRY	No.2		
I - A	2x4	DRY	No.2		

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TTWW+m	MT20	5.0	6.0	2.00	1.50
C	TTW-m	MT20	4.0	4.0		
D	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMV1+p	MT20	3.0	4.0		
F	BMVWW-t	MT20	4.0	9.0		
G	BMVWW-t	MT20	4.0	9.0		
H	BMVWW-t	MT20	4.0	9.0		
I	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
VERT	HORZ	DOWN	HORZ
UPLIFT	IN-SX	IN-SX	IN-SX
JT	694	0	894
I	694	0	894
F	820	0	820
		0	0
		5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	451	322 / 0	0 / 0	0 / 0	0 / 0	169 / 0	0 / 0
F	577	392 / 0	0 / 0	0 / 0	0 / 0	185 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. CSI (LC)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO			FROM	TO	LENGTH	FR-TO		
A-B	-486 / 0	-91.8	-91.8	0.23 (1)	6.25	H-B	-106 / 26	0.04 (1)
B-C	-401 / 0	-91.8	-91.8	0.17 (1)	6.25	B-G	0 / 0	0.00 (1)
C-D	-486 / 0	-91.8	-91.8	0.23 (1)	6.25	G-C	-106 / 26	0.04 (1)
D-E	0 / 35	-91.8	-91.8	0.12 (1)	10.00	A-H	0 / 445	0.10 (1)
E-F	-659 / 0	0.0	0.0	0.08 (1)	7.61	G-D	0 / 445	0.10 (1)
F-G	-784 / 0	0.0	0.0	0.10 (1)	7.61			
I-H	0 / 0	-18.5	-18.5	0.08 (4)	10.00			
H-G	0 / 402	-18.5	-18.5	0.11 (4)	10.00			
G-F	0 / 0	-18.5	-18.5	0.08 (4)	10.00			

TOTAL WEIGHT = 57 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	DL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	DL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = 1/360 (0.42")
CALCULATED VERT. DEFL. (LL) = 1/999 (0.01")
ALLOWABLE DEFL. (TL) = 1/360 (0.42")
CALCULATED VERT. DEFL. (TL) = 1/999 (0.02")

CSI: TC=0.23/1.00 (A-B:1), BC=0.11/1.00 (G-H:4), WB=0.10/1.00 (A-H:1), SS=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.55 (D) (INPUT = 0.90)
JSI METAL = 0.16 (D) (INPUT = 1.00)



Structural component only
DWG# T-2006831

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408318	PB1	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 23 15:32:45 2020 Page 1					
ID:HJ7_mBNWkyCmBzl_hTT?DUZjdZA-mpBWmZEEEXP1nKkTXCmC6bi9p2DlwYhy_odYbvrzNpOW					
7-7-11 10-7-11 3-0-0 10-7-11					
Scale = 1:16.8					

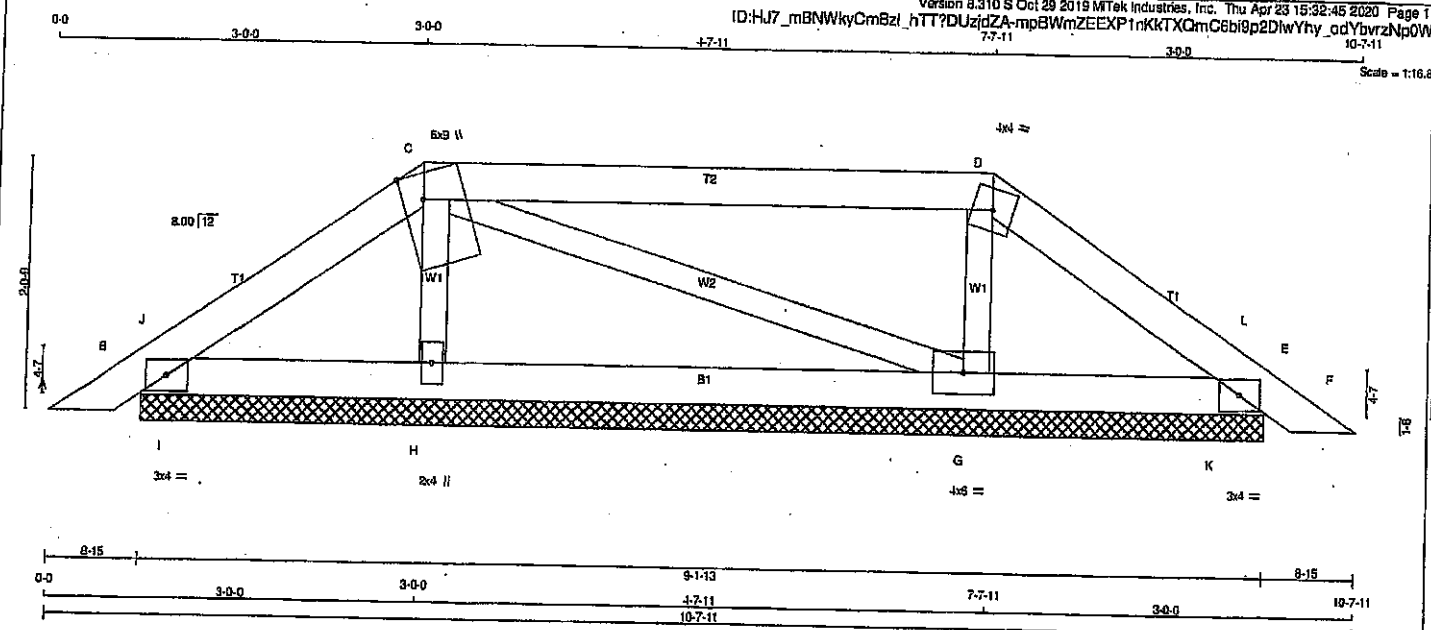

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
B - E	2x4	DRY	No.2
ALL WEBS 2x3 DRY			
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	3.0	4.0	
C	TTWW-m	MT20	8.0	9.0	Edge 2.00
D	TTWW-m	MT20	4.0	4.0	
E	TMB1-I	MT20	3.0	4.0	
G	BMWW1-I	MT20	4.0	6.0	
H	BMWW1-w	MT20	2.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	DOWN	DOWN	BRG	BRG
B	217	0	217	0	9-1-13
E	208	0	208	0	9-1-13
H	343	0	343	0	9-1-13
G	382	0	382	0	9-1-13

UNFACTORED REACTIONS

1ST CASE	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
JT	151	115.0	0.0	0.0	0.0	36.0	0.0
B	144	110.0	0.0	0.0	0.0	34.0	0.0
E	244	150.0	0.0	0.0	0.0	94.0	0.0
G	259	161.0	0.0	0.0	0.0	97.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	MAX. (PL)	MEMB.	FORCE (LBS)	MAX. (PL)	MAX. (LC)
FR-TO				FR-TO			
A-B	0.15	-91.8	-91.8 0.03 (1)	H-C	-250.0	0.04 (1)	10.00
B-J	-59.0	-91.8	-91.8 0.01 (1)	C-G	-15.0	0.01 (1)	8.25
J-C	-78.0	-91.8	-91.8 0.05 (1)	G-D	-265.0	0.04 (1)	6.25
C-D	-32.0	-91.8	-91.8 0.05 (1)	I-J	-134.0	0.00 (1)	6.25
D-L	-82.0	-91.8	-91.8 0.05 (1)	K-L	-135.0	0.00 (1)	6.25
L-E	-42.0	-91.8	-91.8 0.01 (1)				
E-F	0.15	-91.8	-91.8 0.03 (1)				
B-I	0.62	-18.5	-18.5 0.06 (1)				10.00
I-H	0.62	-18.5	-18.5 0.07 (4)				10.00
H-G	0.46	-18.5	-18.5 0.06 (4)				10.00
G-K	0.49	-18.5	-18.5 0.06 (4)				10.00
K-E	0.49	-18.5	-18.5 0.06 (1)				10.00

TOTAL WEIGHT = 2 X 30 = 59 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.34/1.00 (C-D-1), BC=0.07/1.00 (H-I-4), WB=0.04/1.00 (D-G-1), SS=0.17/1.00 (C-D-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788
		1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.80 I)

JSI METAL= 0.05 (H) (INPUT = 1.00 I)

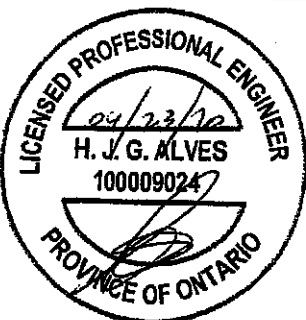


Structural component only
DWG# T-2006815

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408318	PB2	2	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.3.10 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 15:32:46 2020 Page 1
ID: HJ7_mBNWkyCmBzl_hTT7DUzjdZA-E7kvzvFslAeyl2L_TjL7vi0ad4yh8M71H18RHhzNpOV
5-1-11 10-7-11

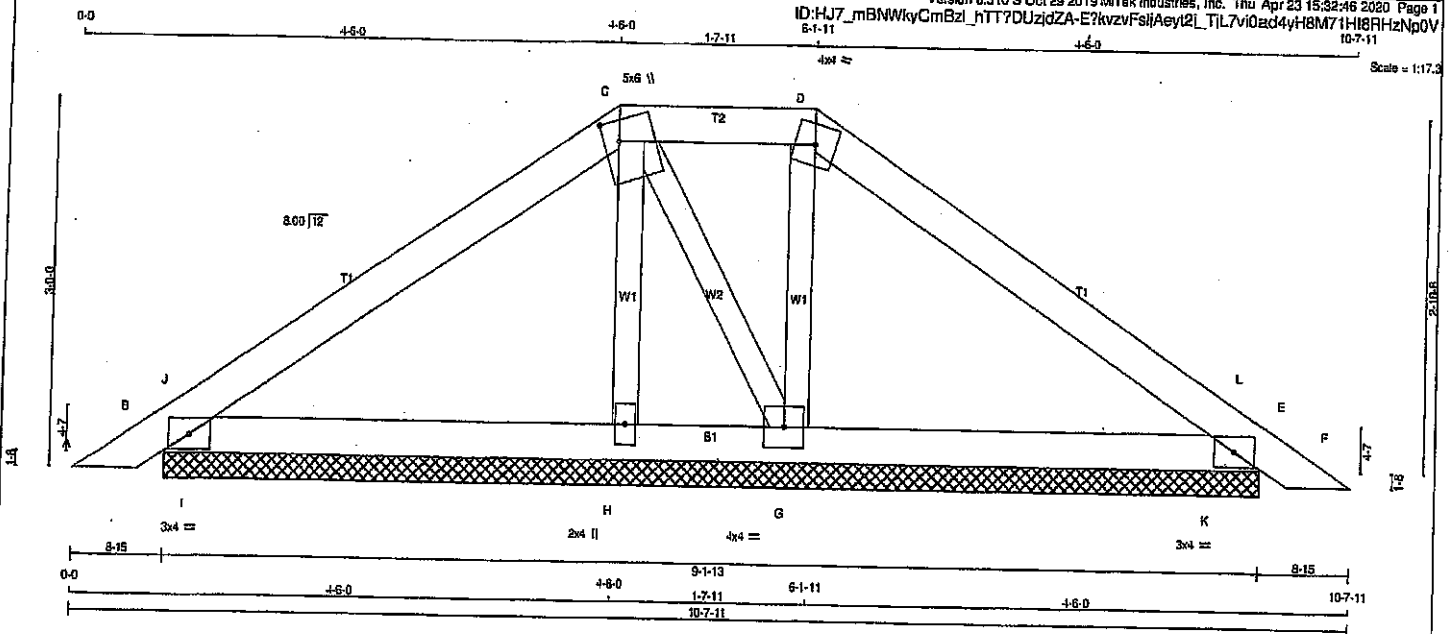

Scale = 1:17.3

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
B - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	3.0	4.0
C	TTWW-m	MT20	5.0	6.0 2.00 1.50
D	TTWW-m	MT20	4.0	4.0
E	TMB1-I	MT20	3.0	4.0
G	BMW1-I	MT20	4.0	4.0
H	BMW1-I	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
B	328	0	328	0	9-1-13	9-1-13
E	312	0	312	0	9-1-13	9-1-13
H	192	0	192	0	9-1-13	9-1-13
G	299	0	299	0	9-1-13	9-1-13

UNFACTORED REACTIONS

JT	1ST CASE COMBINED		MAX-MIN. COMPONENT REACTIONS		PERM. LIVE	WIND	DEAD	SOIL
	SNOW	LIVE	SNOW	LIVE				
B	230	163.0	0.0	0.0	0.0	0.0	67.0	0.0
E	219	153.0	0.0	0.0	0.0	0.0	65.0	0.0
H	138	80.0	0.0	0.0	0.0	0.0	58.0	0.0
G	211	140.0	0.0	0.0	0.0	0.0	71.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0.15	-91.8	-91.8 0.03 (1)	H-C	-105.0	0.02 (1)	
B-J	-48.0	-91.8	-91.8 0.08 (1)	C-G	-52.0	0.01 (1)	
J-C	-135.0	-91.8	-91.8 0.16 (1)	G-D	-166.0	0.03 (1)	
C-D	-75.0	-91.8	-91.8 0.04 (1)	D-J	-303.0	0.00 (1)	
D-L	-106.0	-91.8	-91.8 0.16 (1)	K-L	-312.0	0.00 (1)	
L-E	-38.0	-91.8	-91.8 0.06 (1)				
E-F	0.15	-91.8	-91.8 0.03 (1)				
B-I	0.106	-18.5	-18.5 0.14 (1)				
I-H	0.106	-18.5	-18.5 0.14 (1)				
H-G	0.102	-18.5	-18.5 0.09 (1)				
G-K	0.82	-18.5	-18.5 0.14 (1)				
K-E	0.82	-18.5	-18.5 0.14 (1)				

TOTAL WEIGHT = 2 X 30 = 61 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA C86-09, CSA C88-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.16/1.00 (C-J:1), BC=0.14/1.00 (H-I:1), WB=0.03/1.00 (D-G:1), SS=0.24/1.00 (E-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.27 (B) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006816

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408318	PB3	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 15:32:48 2020 Page 1					
ID: HJ7_mBNWkyCmBzL_hTT7DUzdZA-AOsfObH6qKQMBBC55ulpDKnLxRkDI2pQUbnFWAZnpOT					
10-7-11					

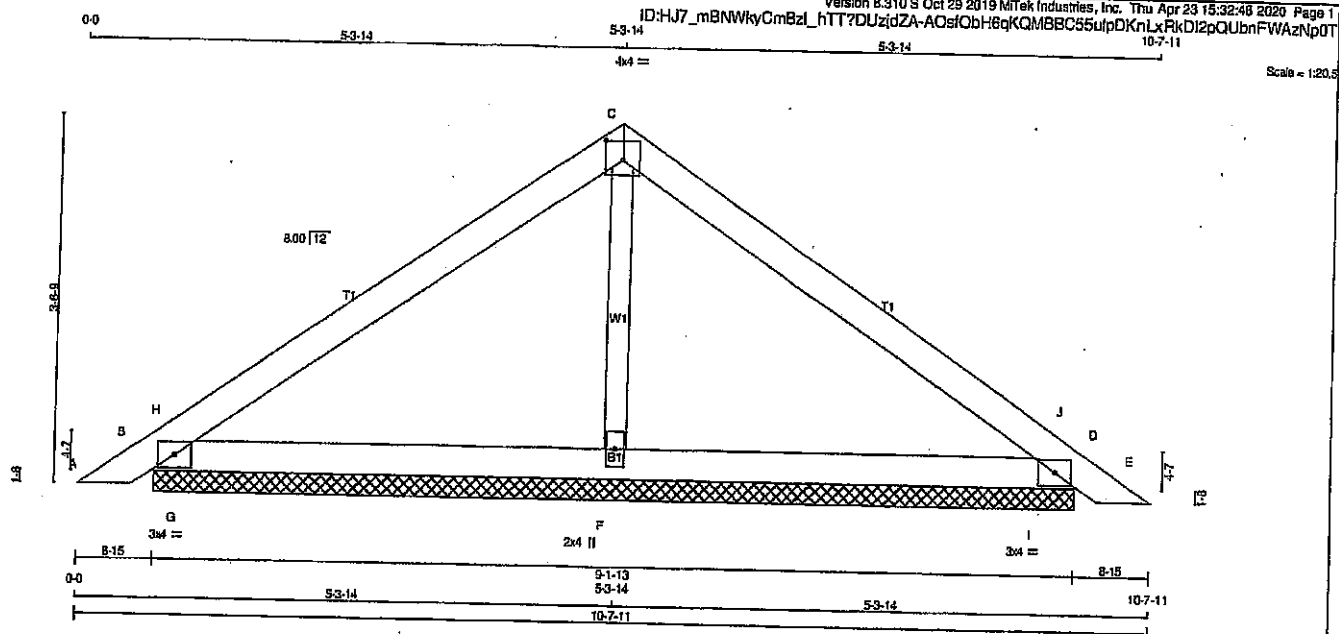

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - E	2x4	DRY	No.2	SPF		
B - D	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
DRY: SEASONED LUMBER.						

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0			
C	TTW-p	MT20	4.0	4.0	2.25	2.00	
D	TMB1-I	MT20	3.0	4.0			
F	BMW1-w	MT20	2.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
B	382	0	382	0	9-1-13	9-1-13
D	382	0	382	0	9-1-13	9-1-13
F	387	0	387	0	9-1-13	9-1-13

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	268	191.0	0.0	0.0	0.0	0.0	77.0	0.0
D	268	191.0	0.0	0.0	0.0	0.0	77.0	0.0
F	282	155.0	0.0	0.0	0.0	0.0	107.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED			WEBS		
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (I/C)	MAX. UNBRAC LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (I/C)
FR-TO		FROM TO					
A-B	0.15	-91.8	-91.8 0.03 (1)	10.00	F-C	-162.0	0.03 (1)
B-H	-38.0	-91.8	-91.8 0.12 (1)	6.25	G-H	-498.0	0.00 (1)
H-C	-182.0	-91.8	-91.8 0.23 (1)	6.25	I-J	-495.0	0.00 (1)
C-J	-182.0	-91.8	-91.8 0.23 (1)	6.25			
J-D	-38.0	-91.8	-91.8 0.12 (1)	6.25			
D-E	0.15	-91.8	-91.8 0.03 (1)	10.00			
B-G	0.142	-18.5	-18.5 0.22 (1)	10.00			
G-F	0.142	-18.5	-18.5 0.22 (1)	10.00			
F-I	0.142	-18.5	-18.5 0.22 (1)	10.00			
I-D	0.142	-18.5	-18.5 0.22 (1)	10.00			

TOTAL WEIGHT = 3 X 27 = 82 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 085-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.23/1.00 (C-J:1), BC=0.22/1.00 (F-I:1), WB=0.03/1.00 (C-F:1), SS=0.37/1.00 (B-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1657 786

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.34 (D) (INPUT = 0.90)
JSI METAL= 0.09 (S) (INPUT = 1.00)



Structural component only
DWG# T-2006817

JOB NAME 408318	TRUSS NAME J2	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
Tamarack Roof Truss, Burlington						

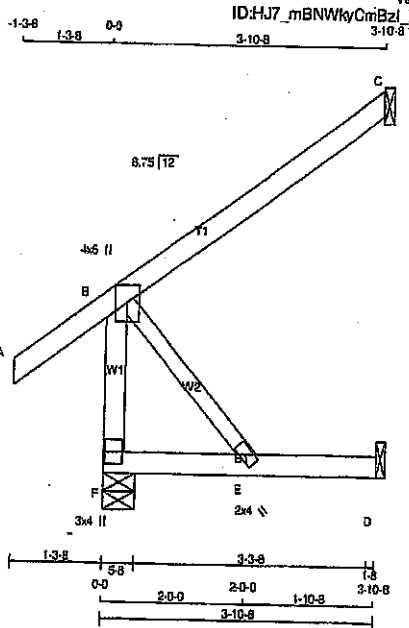

Scale = 1/20

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	6.0	Edge
E	BMV+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
F	340	340	5-8	5-8
C	178	178	1-8	1-8
D	36	40	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
F	238	170.0	0.0	0.0	68.0	0.0
C	122	98.0	0.0	0.0	23.0	0.0
D	29	0.0	0.0	0.0	29.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LENGTH (FT)	
F-B	-304.0	0.0	0.04 (1)	7.81	0.0	0.00 (1)	
A-B	0.37	-91.8	0.14 (5)	10.00			
B-C	0.0	-91.8	0.23 (1)	10.00			
F-E	0.0	-18.5	0.08 (4)	10.00			
E-D	0.0	-18.5	0.08 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 6 X 17 = 89 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CS: TC=0.23/1.00 (B-C:1), BC=0.09/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.18 (B) (INPUT = 0.90)
JSI METAL=0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006814

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408319	T21	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 8 Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 15:38:32 2020 Page 1
ID: 5VQZPIKEwF0JO1uJWFAzjccR-cJOLPB_d39ea3ck9DxnLIZ3eHjAFEHhO7R26NBzNoyz

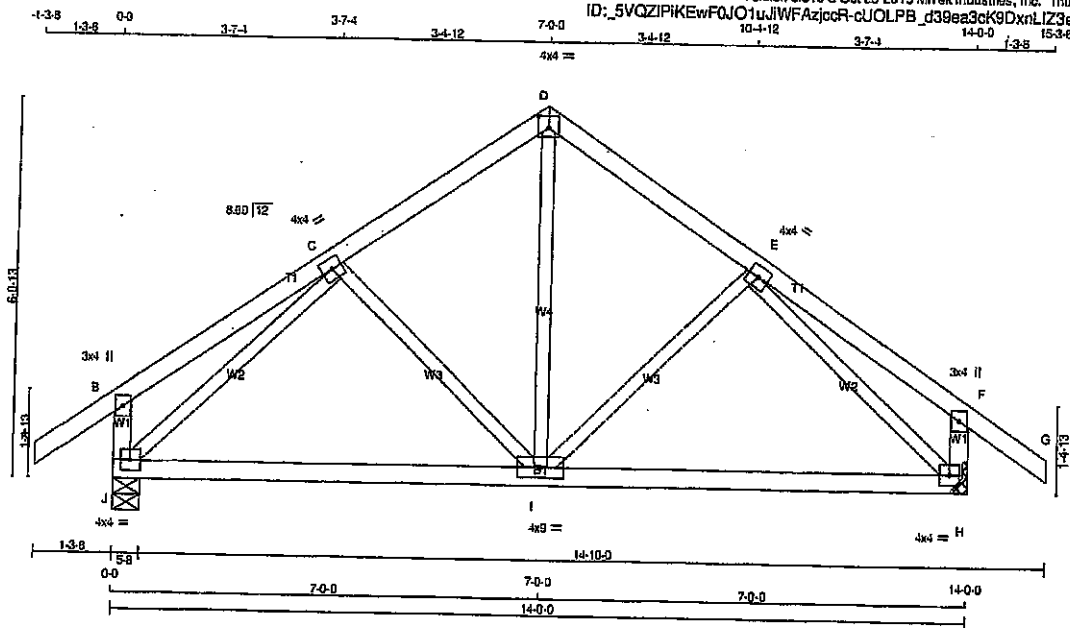

Scale = 1:33.9

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0		
C	TMVW-1	MT20	4.0	4.0		
D	TTW-p	MT20	4.0	4.0	2.25	2.00
E	TMVW-1	MT20	4.0	4.0		
F	TMV-p	MT20	3.0	4.0		
H	BMVW-1	MT20	4.0	4.0		
I	BMVW-1	MT20	4.0	4.0		
J	BMVW-1	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
J	898	0	898	0	0	5-8	5-8
H	898	0	898	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	632	428.0	0.0	0.0	0.0	204.0	0.0
H	632	428.0	0.0	0.0	0.0	204.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. FACTORED (LBS)	MEMB.	FORCE (LBS)	MAX. FACTORED (LBS)	MAX. FACTORED (LBS)
FR-TO		FROM TO		FR-TO			
A-B	0.35	-91.8	-91.8 0.12 (1)	10.00	F-D	0.401	0.09 (1)
B-C	0.20	-91.8	-91.8 0.18 (1)	10.00	F-E	-174.0	0.07 (1)
C-D	-607.0	-91.8	-91.8 0.14 (1)	8.25	C-I	-174.0	0.07 (1)
D-E	-607.0	-91.8	-91.8 0.14 (1)	8.25	J-C	-857.0	0.32 (1)
E-F	0.20	-91.8	-91.8 0.18 (1)	10.00	E-H	-857.0	0.32 (1)
F-G	0.35	-91.8	-91.8 0.18 (1)	10.00			
J-B	-250.0	0.0	0.0 0.03 (1)	7.81			
H-F	-250.0	0.0	0.0 0.03 (1)	7.81			
J-I	0.613	-18.5	-18.5 0.31 (4)	10.00			
I-H	0.613	-18.5	-18.5 0.31 (4)	10.00			

TOTAL WEIGHT = 2 X 61 = 121 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
DL	= 6.0	PSF	
BOT CH.	LL	= 0.0	PSF
DL	= 7.4	PSF	
TOTAL LOAD	= 39.0	PSF	

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCG 2010, NBCG 2012, ABC 2019
- PART 9 OF NBCG 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.47")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01")
ALLOWABLE DEFL. (TL) = $L/360$ (0.47")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.05")

CSI: TC=0.18/1.00 (B-C-I), BC=0.31/1.00 (H-I), WB=0.32/1.00 (C-J-I), SS=0.13/1.00 (C-D-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.73 (C) (INPUT = 0.90)
JSI METAL= 0.30 (E) (INPUT = 1.00)



Structural component only
DWG# T-2006836

JOB NAME 408319	TRUSS NAME T21S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 15:36:33 2020 Page 1
ID: 5VQZIPKEwFQJ01uJWFAzjccR-4gyicW7FqSmRhmVlnflaqncpE7V7ziWYD5nfdzNoyy

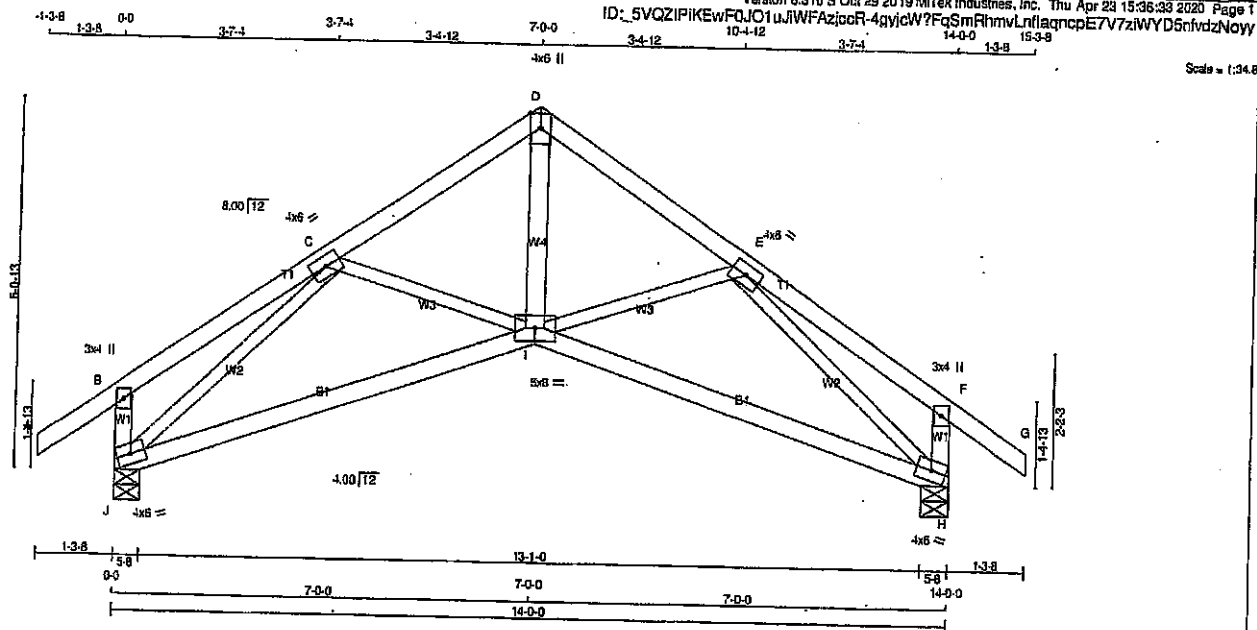

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
J - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
I - D	2x4	DRY	No.2

PLATES (tables in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMWW-t	MT20	4.0	6.0	
D	TTW+p	MT20	4.0	6.0	Edge
E	TMWW-t	MT20	4.0	6.0	
F	TMV+p	MT20	3.0	4.0	
H	BMVW1-t	MT20	4.0	6.0	
I	BBVWW-p	MT20	5.0	8.0	
J	BMVW1-t	MT20	4.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
J	898	0	0	898	0	0	5-8	5-8	5-8
H	898	0	0	898	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
J	832	428 / 0	0 / 0	0 / 0	0 / 0
H	832	428 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO	
A-B	0 / 35	-91.8	10.00	I-D	0 / 759
B-C	0 / 18	-91.8	10.00	I-E	-95 / 18
C-D	-931 / 0	-91.8	6.25	C-I	-95 / 18
D-E	-931 / 0	-91.8	6.25	J-C	-1210 / 0
E-F	0 / 18	-91.8	10.00	E-H	-1210 / 0
F-G	0 / 35	-91.8	10.00		
J-B	-254 / 0	0.0	7.81		
H-F	-254 / 0	0.0	7.81		
J-I	0 / 895	-18.5	10.00		
I-H	0 / 895	-18.5	10.00		

TOTAL WEIGHT = 2 X 59 = 118 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.47")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.47")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.16/1.00 (B-C:1), BC=0.33/1.00 (I-J:4), WB=0.48/1.00 (C-J:1), SSI=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(FBI) (PLJ) (PLJ)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.72 (J) (INPUT = 0.99)
JSI METAL = 0.29 (H) (INPUT = 1.00)



Structural component only
DWG# T-2006837

JOB NAME 408319	TRUSS NAME T22	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 23 15:38:34 2020 Page 1
 ID: 5VQZPIKEwF0JO1uJiWFAzccR-YsW5s0t6muJwTXKMppN_8zuXvpIenhSIXDR4zNayx

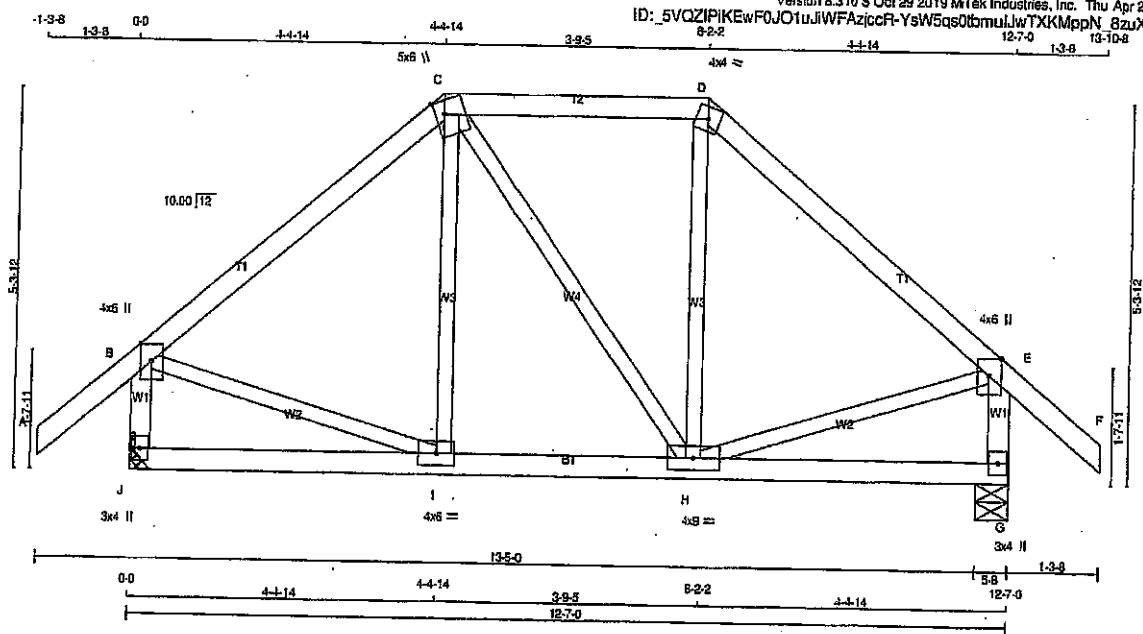

Scale = 1/2\"/>

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
J - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
J - G	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	6.0	Edge
C	TTWV+m	MT20	5.0	8.0	2.25 1.50
D	TTW-m	MT20	4.0	4.0	
E	TMVW+p	MT20	4.0	6.0	Edge
G	BMV1+p	MT20	3.0	4.0	
H	BMVWV-1	MT20	4.0	9.0	
I	BMVWV-1	MT20	4.0	6.0	
J	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED GROSS REACTION	VERT	HORZ	MAXIMUM FACTORED GROSS REACTION	DOWN	HORZ	INPUT REORD BRG IN-SX
J	821	0	0	821	0	0	MECHANICAL
G	821	0	0	821	0	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3'-8\"/>

UNFACTORED REACTIONS							
JT	1ST LOASE	MAX	MIN	COMPONENT	REACTIONS		
J	COMBINED	SNOW	LIVE	PERM	LIVE	WIND	DEAD
J	578	393 / 0	0 / 0	0 / 0	0 / 0	0 / 0	185 / 0
G	578	393 / 0	0 / 0	0 / 0	0 / 0	0 / 0	185 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSF (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSF (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	I-C	-35 / 50	0.02 (4)	
B-C	-528 / 0	-91.8	-91.8 0.23 (1)	C-H	0 / 0	0.08 (1)	
C-D	-404 / 0	-91.8	-91.8 0.17 (1)	H-D	-35 / 50	0.02 (4)	
D-E	-528 / 0	-91.8	-91.8 0.23 (1)	B-I	0 / 421	0.09 (1)	
E-F	0 / 41	-91.8	-91.8 0.13 (1)	H-E	0 / 421	0.09 (1)	
J-B	-785 / 0	0.0	0.0 0.08 (1)				
G-E	-785 / 0	0.0	0.0 0.08 (1)				
J-I	0 / 0	-18.5	-18.5 0.08 (4)				
I-H	0 / 404	-18.5	-18.5 0.11 (4)				
H-G	0 / 0	-18.5	-18.5 0.08 (4)				

TOTAL WEIGHT = 58 lb (M/F)

DESIGN CRITERIA			
SPECIFIED LOADS:			
TOP CH.	LL = 25.6	PSF	
DL = 6.0	PSF		
BDT CH.	LL = 0.0	PSF	
DL = 7.4	PSF		
TOTAL LOAD = 39.0	PSF		

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.42")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
 ALLOWABLE DEFL.(TL) = L/360 (0.42")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSK: TC=0.23/1.00 (B-C:1), BC=0.11/1.00 (H-I:4), WB=0.09/1.00 (B-I:1), SS=0.14/1.00 (G-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL. IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PL)	MAX MIN	MAX MIN	MAX MIN
MT20	518	354	1667	788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.51 (B) (INPUT = 0.50)
 JSI METAL= 0.31 (B) (INPUT = 1.00)




Structural component only
 DWG# T-2006838

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408319	T23X	1	2	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 07:48:35 2020 Page 1
ID: 5VQZPIKEwF0JO1uJWFAzjccR-Rs7r7pbwujDacJMLJdIai7T14eMvj1LrbvCzNaig

1-3-8 0-0 4-0-11 4-0-11 5-8-9 9-9-3 5-3-9 15-0-12 15-1-8 17-0-12 4-12 1-8-4 3-11-1 20-11-13 5-8-9 26-0-6 31-5-0 4-8-10
Scale = 1:50.7

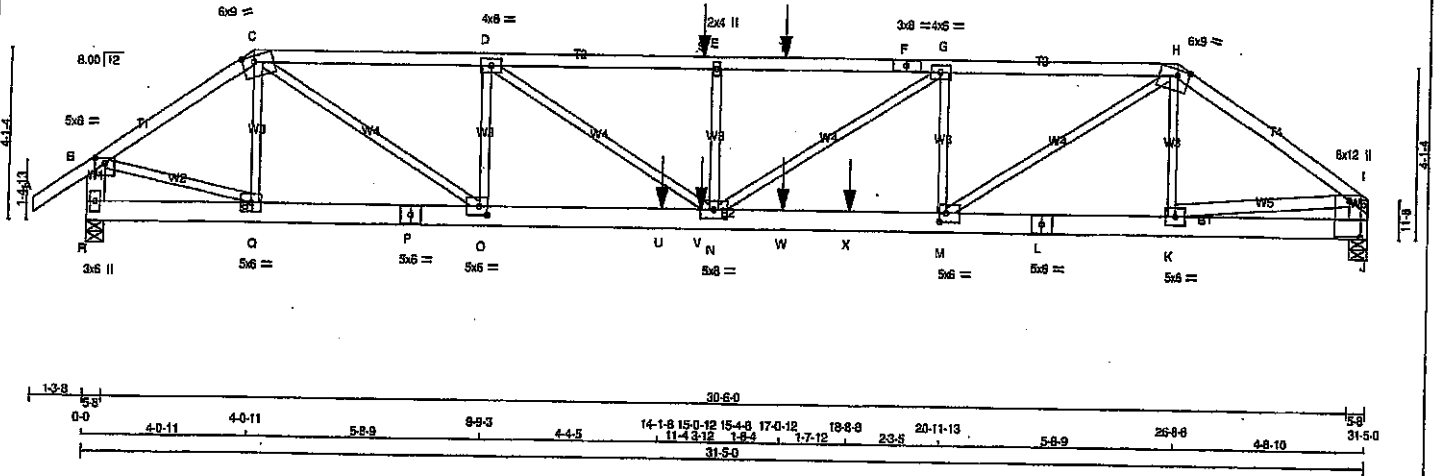

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
R - B	2x6	DRY	No.2
J - I	2x6	DRY	No.2
R - P	2x6	DRY	1650F 1.5E
P - L	2x6	DRY	1650F 1.5E
L - J	2x6	DRY	1650F 1.5E
ALL WEBS	2x3	DRY	No.2
K - I	2x4	DRY	No.2

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122'X3') SPIRAL NAILS		
A-C	12	TOP
C-F	12	TOP
F-H	12	TOP
H-I	12	TOP
R-B	2	TOP
J-I	2	TOP
BOTTOM CHORDS: (0.122'X3') SPIRAL NAILS		
R-P	12	TOP
P-L	12	TOP
L-J	2	TOP
WEBS: (0.122'X3') SPIRAL NAILS		
2x3	6	TOP
2x4	1	TOP

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	UP	BRG	BRG	IN-SX	IN-SX
R	3413	0	3413	0	0	5-8	5-8		
J	3401	0	3401	0	0	5-8	5-8		

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	2405	1628 / 0	0 / 0	0 / 0	0 / 0	777 / 0	0 / 0
J	2398	1614 / 0	0 / 0	0 / 0	0 / 0	765 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.62 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM	TO		FR-TO			
A-B	0 / 35	-91.8	-91.8	0.07 (1)	10.00	C-C	-731 / 0	0.09 (1)
B-C	-4080 / 0	-91.8	-91.8	0.22 (1)	4.53	C-O	0 / 4722	0.58 (1)
C-D	-7310 / 0	-91.8	-91.8	0.55 (1)	3.28	O-D	-2238 / 0	0.28 (1)
D-S	-9818 / 0	-91.8	-91.8	0.79 (1)	2.66	D-N	0 / 3011	0.37 (1)
S-E	-9818 / 0	-91.8	-91.8	0.79 (1)	2.66	N-E	-662 / 0	0.08 (1)
E-T	-9818 / 0	-91.8	-91.8	0.82 (1)	2.62	N-G	0 / 2067	0.28 (1)
T-F	-9818 / 0	-91.8	-91.8	0.82 (1)	2.62	M-G	-1749 / 0	0.22 (1)
F-G	-9818 / 0	-91.8	-91.8	0.82 (1)	2.62	M-H	0 / 4915	0.51 (1)
G-H	-8096 / 0	-91.8	-91.8	0.65 (1)	3.05	K-H	-454 / 0	0.08 (1)
H-I	-4801 / 0	-91.8	-91.8	0.33 (1)	4.13	S-Q	0 / 3488	0.43 (1)
R-B	-3381 / 0	0.0	0.0	0.12 (1)	7.58	K-I	0 / 4015	0.35 (1)
J-I	-3345 / 0	0.0	0.0	0.12 (1)	7.61			

FR-TO	MEMB.	FORCE	VERT. LOAD	LC1	MAX	MEMB.	FORCE	MAX	CS1 (LC)
R-Q	0 / 0	-18.5	-18.5	0.02 (4)	10.00				
Q-P	0 / 3352	-18.5	-18.5	0.17 (1)	10.00				
P-O	0 / 3352	-18.5	-18.5	0.17 (1)	10.00				
O-U	0 / 7311	-18.5	-18.5	0.53 (1)	10.00				
U-V	0 / 7311	-18.5	-18.5	0.53 (1)	10.00				
V-N	0 / 7311	-18.5	-18.5	0.53 (1)	10.00				
N-W	0 / 8096	-18.5	-18.5	0.65 (1)	10.00				
W-X	0 / 8096	-18.5	-18.5	0.65 (1)	10.00				
X-M	0 / 8096	-18.5	-18.5	0.65 (1)	10.00				
M-L	0 / 3976	-18.5	-18.5	0.28 (1)	10.00				
L-K	0 / 3976	-18.5	-18.5	0.28 (1)	10.00				
K-J	0 / 0	-18.5	-18.5	0.02 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	FACE	DIR.	TYPE	HEEL	CONN.
S	15-0-12	-110	-110	---	BACK	VERT	TOTAL	C1
T	17-0-12	-110	-110	---	BACK	VERT	TOTAL	C1
U	14-1-8	-1562	-1562	---	BACK	VERT	TOTAL	C1
V	15-0-12	-26	-26	---	BACK	VERT	TOTAL	C1
W	17-0-12	-26	-26	---	BACK	VERT	TOTAL	C1
X	18-8-8	-1389	-1389	---	BACK	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 141 = 282 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBCO 2018, CBC 2012, ABC 2018
- PART 9 OF CBCO 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.05')
CALCULATED VERT. DEFL. (LL) = L/999 (0.26')
ALLOWABLE DEFL. (TL) = L/360 (1.05')
CALCULATED VERT. DEFL. (TL) = L/797 (0.47')

CS1: TC=0.82/1.00 (E-G:1), BC=0.88/1.00 (M-N:1), WB=0.61/1.00 (H-M:1), SS1=0.47/1.00 (N-O:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (H) (INPUT = 0.90)
JSI METAL = 0.51 (M) (INPUT = 1.00)



Structural component only
DWG# T-2006840 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408319	T23X	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 24 07:48:35 2020 Page 2
ID: 5VQZPIKEwFDJO1uJIWFazccR-Rs?r7robwuiDecUMLJdlet7Tt4eMv11LrbvCzNaio


PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.50	3.00
C	TTWW-m	MT20	6.0	9.0	1.75	3.50
D	TMVW-t	MT20	4.0	6.0		
E	TMVW-w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMVW-t	MT20	4.0	6.0		
H	TTWW-m	MT20	6.0	9.0	1.75	3.50
I						
J	TMVWVW1*-p	MT20	8.0	12.0	10.25	3.50
K	BMVW-t	MT20	5.0	6.0		
L	BS-t	MT20	5.0	6.0		
M	BMVW-t	MT20	5.0	6.0	2.50	2.00
N	BMVWVW-t	MT20	5.0	6.0		
O	BMVW-t	MT20	5.0	6.0	2.50	2.25
P	BS-t	MT20	5.0	6.0		
Q	BMVW-t	MT20	5.0	6.0		
R	BMV1-p	MT20	3.0	6.0		



Structural component only
DWG# T-2006840

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408319	J21	5	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 15:36:29 2020 Page 1					
ID: 5VQZIPiKEwF0JO1uJIWFAZccR-Cv Cn9yknEG7C9baYpDdgrR66WC417?yJUpSnszNoz0					
Scale = 1:29.3					

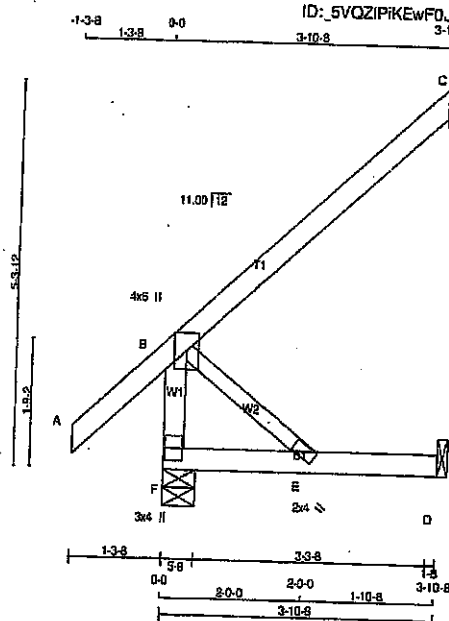

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	5.0	Edge	
E	BMVW+p	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	UP	IN-SX
F	341	0	0	5-8
C	178	0	0	1-8
D	38	0	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED							
F	239	170 / 0	0 / 0	0 / 0	0 / 0	69 / 0	0 / 0	0 / 0
C	122	98 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0	0 / 0
D	29	0 / 0	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED	MAX
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CS1 (LC)	UNBRAC	LENGTH	FR-TO	MEMB.	FORCE (LBS)	MAX CS1 (LC)
FR-TO		FROM TO							
F-B	-305 / 0	0.0	0.0	0.03 (1)	7.81	B-E	0 / 0	0.00 (1)	
A-B	0 / 43	-91.8	-91.8	0.14 (5)	10.00				
B-C	0 / 0	-91.8	-91.8	0.23 (1)	10.00				
F-E	0 / 0	-18.5	-18.5	0.08 (4)	10.00				
E-D	0 / 0	-18.5	-18.5	0.08 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 6 X 16 = 97 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/899 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/899 (0.01")

OSI: TC=0.23/1.00 (B-C:1), BC=0.08/1.00 (E-F:4), WB=0.03/1.00 (B-E:1), SSI=0.10/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.22 (B) (INPUT = 0.30)
JSI METAL=0.08 (B) (INPUT = 1.00)

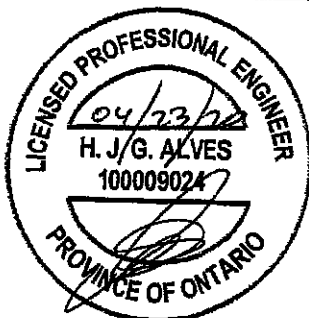


Structural component only
DWG# T-2006833

JOB NAME 408319	TRUSS NAME J22	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 28 15:38:30 2020 Page 1
ID: 5VQZIPIKEWFOJ01uJWFAzjccR-g5Ha_VzNYXOsqJAm5WksCB_FAwWnmSP6X7Z?JJzNoz?

Scale = 1:13.1

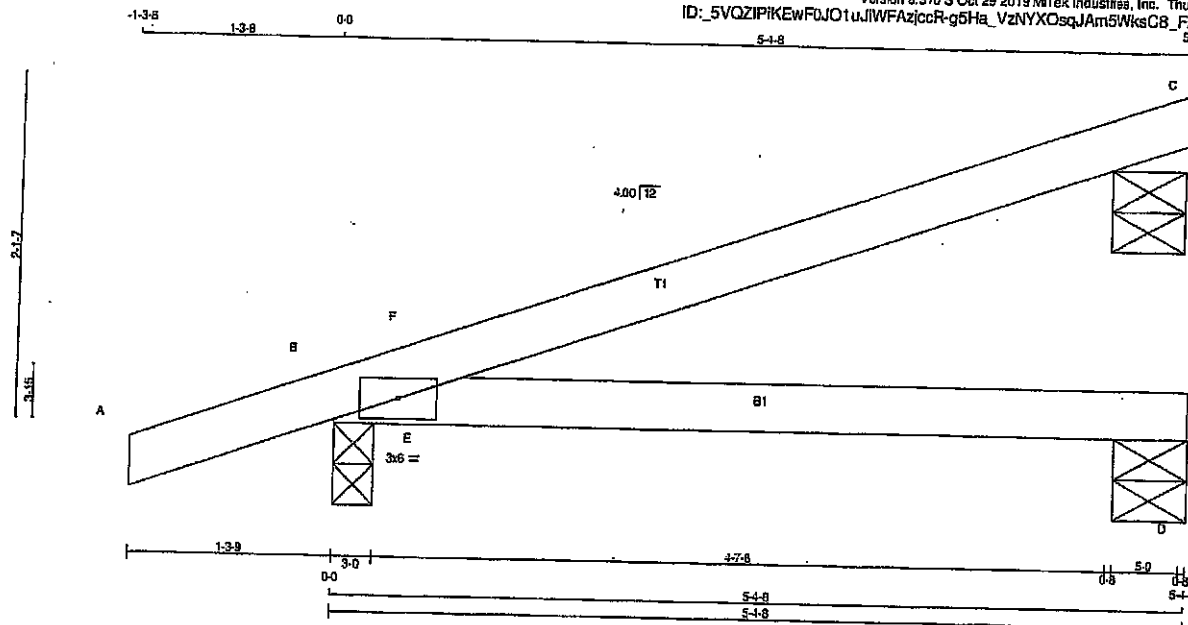

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER
A - C 2x4 DRY No.2
B - D 2x4 DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-1	MT20	3.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT SRG IN-SX	REQD SRG IN-SX
	VERT	HORZ	DOWN	UP		
C	215	0	215	0	5-8	5-8
B	419	0	419	0	5-8	5-8
D	81	0	81	0	5-8 (5-7)	5-8

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

JT	1ST CASE COMBINED		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM. LIVE	WIND			
C	149	116 / 0	0 / 0	0 / 0	33 / 0	0 / 0	0 / 0
B	294	206 / 0	0 / 0	0 / 0	88 / 0	0 / 0	0 / 0
D	61	22 / 0	0 / 0	0 / 0	39 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM	TO		FR-TO				
A-B	0 / 18	-91.8	-91.8	0.11 (1)	10.00	E-F	-280.11	0.00 (1)	
B-F	-18.10	-91.8	-91.8	0.06 (4)	6.25				
F-C	-1.2	-91.8	-91.8	0.34 (1)	10.00				
B-E	0 / 0	-18.5	-18.5	0.24 (1)	10.00				
E-D	0 / 0	-18.5	-18.5	0.24 (1)	10.00				

TOTAL WEIGHT = 6 X 14 = 86 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/380 (0.19")
CALCULATED VERT. DEFL.(TL) = L/634 (0.10")

CSL TO=0.34/1.00 (C-F:1), BD=0.24/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SS=0.23/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20 618 354	1657 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006834

JOB NAME 408319	TRUSS NAME J23	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 15:38:31 2020 Page 1	
				ID: 5VQZPIKEwFOJO1uJlWFAzpcR-8HryBrz?JhWSSlyEG5IMWPTKq4VvVfmmIzfrzNoz_	

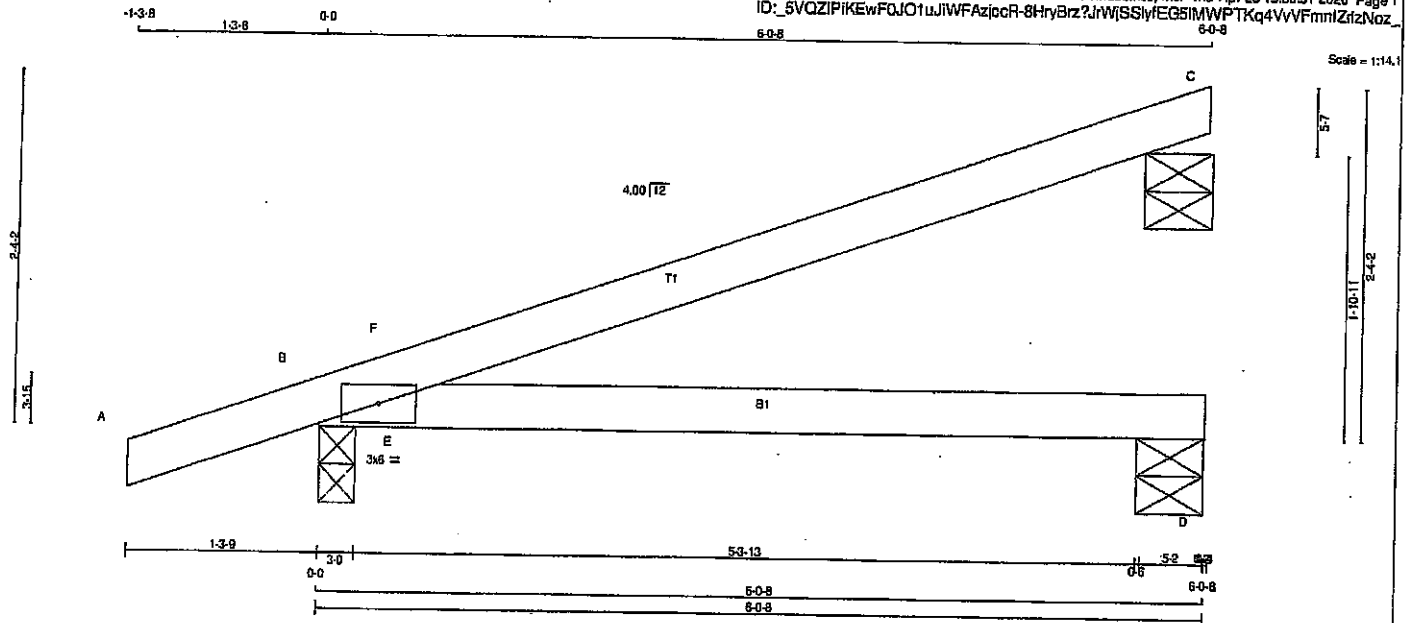

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER
A - C 2x4 DRY No.2
B - D 2x4 DRY No.2
DRY: SEASONED LUMBER.

PLATES (table is in inches)
JT TYPE PLATES W LEN Y X
B TMB1-MT20 3.0 6.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX		REQD BRG IN-SX	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX
C	242	0	242	0	0	5-8 (5-4)	5-8	5-8
B	458	0	458	0	0	3-0	3-0	3-0
D	91	0	91	0	0	5-8	5-8	5-8

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

JT	1ST CASE COMBINED		MAX. MIN. COMPONENT REACTIONS		PERM. LIVE	WIND	DEAD	SOIL
	SNOW	LIVE	SNOW	LIVE				
C	168	131/0	0/0	0/0	0/0	0/0	37/0	0/0
B	320	223/0	0/0	0/0	0/0	0/0	97/0	0/0
D	68	24/0	0/0	0/0	0/0	0/0	44/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)		FACTORED VERT. LOAD (PLF)		MAX. LOAD (LC1)		MAX. UNBRACED LENGTH (FT)		WEBS MAX. FACTORED FORCE (LBS)		MAX. LOAD (LC1)	
	FR-TO	FROM	FR-TO	FROM	FR-TO	FROM	FR-TO	FROM	FR-TO	FROM	FR-TO	FROM
A-B	0/18	-91.8	-91.8	0.11 (1)	10.00	E-F	-345/13	0.00 (1)				
B-F	-20/22	-91.8	-91.8	0.07 (4)	6.25							
F-C	-2/2	-91.8	-91.8	0.44 (1)	10.00							
B-E	0/0	-18.5	-18.5	0.30 (1)	10.00							
E-D	0/0	-18.5	-18.5	0.30 (1)	10.00							

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/826 (0.08")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/452 (0.16")

CSI: TC=0.44/1.00 (C-F:1), BC=0.30/1.00 (D-E:1),
WB=0.00/1.00 (E-F:1), SS=0.29/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSD)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20 618 354	1687 768	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.20 (B) (INPUT = 0.99)
JSI METAL = 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006835

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408320	T31	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

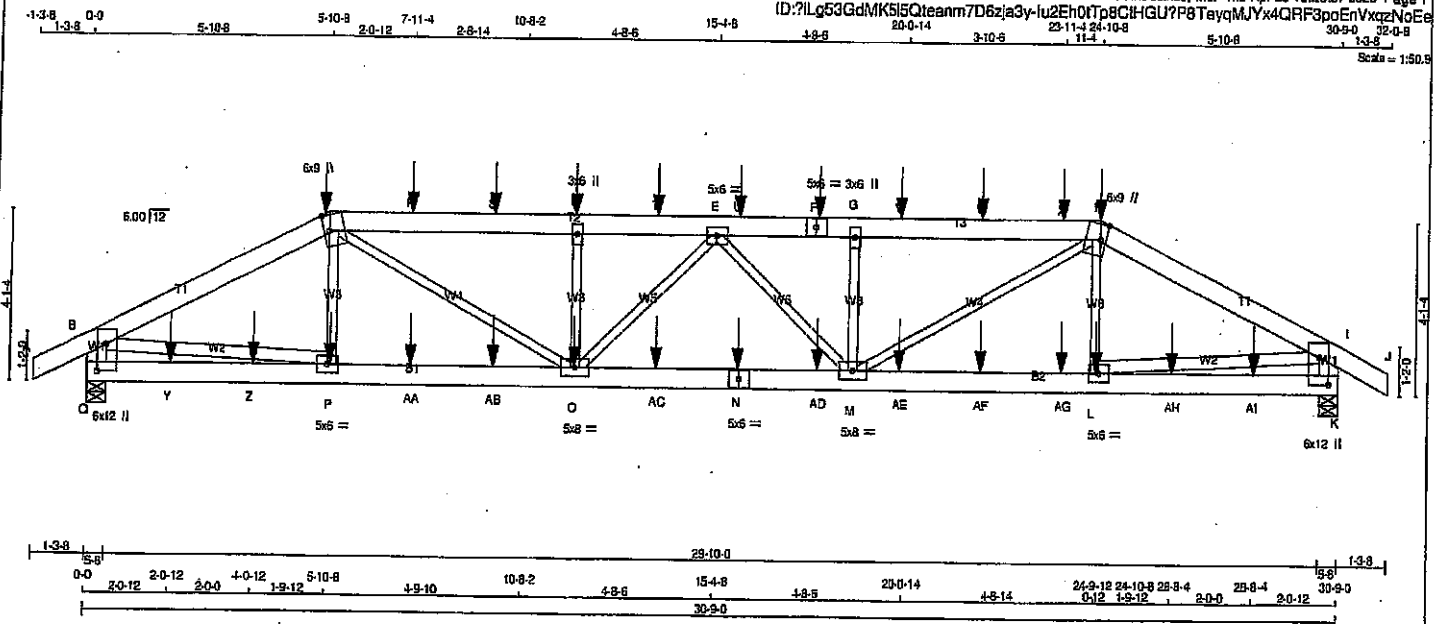

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x6	DRY No.2	SPF
C - F	2x6	DRY No.2	SPF
F - H	2x6	DRY No.2	SPF
H - J	2x6	DRY No.2	SPF
Q - B	2x6	DRY No.2	SPF
K - I	2x6	DRY No.2	SPF
Q - N	2x6	DRY No.2	SPF
N - K	2x6	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			
B - P	2x4	DRY No.2	SPF
L - I	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C 2	12	SIDE(122.0)
C-F 2	12	SIDE(183.1)
F-H 2	12	SIDE(81.0)
H-J 2	12	SIDE(122.0)
Q-B 2	12	TOP
K-I 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
Q-N 2	12	SIDE(183.1)
N-K 2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	
2x4 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	IN-SX	IN-SX
Q	2855	0	0	5-8
K	3001	0	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE WIND DEAD SOIL
JT COMBINED SNOW	LIVE	
Q	2088 1377.0	0.0 0.0 711.0 0.0
K	2121 1388.0	0.0 0.0 723.0 0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED MEMB. FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO		
A-B	0/29	-91.8	-91.8 0.03 (1)	10.00	P-C	-246/79
B-C	-4519/0	-91.8	-91.8 0.19 (1)	5.24	C-O	0/2336
C-R	-6037/0	-91.8	-91.8 0.26 (1)	4.80	O-D	-848/0
R-S	-6037/0	-91.8	-91.8 0.26 (1)	4.80	E-E	-216/0
S-D	-6037/0	-91.8	-91.8 0.26 (1)	4.60	M-H	-167/0
D-T	-6037/0	-91.8	-91.8 0.18 (1)	4.88	M-G	-857/0
T-E	-6037/0	-91.8	-91.8 0.18 (1)	4.68	M-H	0/2288
E-U	-6071/0	-91.8	-91.8 0.19 (1)	4.65	L-H	-241/91
U-F	-6071/0	-91.8	-91.8 0.19 (1)	4.65	S-P	0/4095
F-G	-6071/0	-91.8	-91.8 0.19 (1)	4.65	L-I	0/4140
G-V	-6071/0	-91.8	-91.8 0.27 (1)	4.58		
V-W	-6071/0	-91.8	-91.8 0.27 (1)	4.58		
W-X	-6071/0	-91.8	-91.8 0.27 (1)	4.58		
X-H	-6071/0	-91.8	-91.8 0.27 (1)	4.58		
H-I	-4603/0	-91.8	-91.8 0.19 (1)	5.21		
I-J	0/29	-91.8	-91.8 0.03 (1)	10.00		
Q-B	-2888/0	0.0	0.0 0.10 (1)	7.81		
K-I	-2932/0	0.0	0.0 0.10 (1)	7.81		

Q-Y	0/0	-18.5	-18.5 0.06 (4)	10.00
Y-Z	0/0	-18.5	-18.5 0.06 (4)	10.00
Z-F	0/0	-18.5	-18.5 0.06 (4)	10.00
P-AA	0/4031	-18.5	-18.5 0.30 (1)	10.00
AA-AB	0/4031	-18.5	-18.5 0.30 (1)	10.00
AB-O	0/4031	-18.5	-18.5 0.30 (1)	10.00
O-AC	0/4031	-18.5	-18.5 0.30 (1)	10.00
AC-N	0/6185	-18.5	-18.5 0.47 (1)	10.00
N-AD	0/6185	-18.5	-18.5 0.47 (1)	10.00
AD-M	0/6185	-18.5	-18.5 0.47 (1)	10.00
M-AE	0/6185	-18.5	-18.5 0.47 (1)	10.00
AE-AF	0/4107	-18.5	-18.5 0.31 (1)	10.00
AF-AG	0/4107	-18.5	-18.5 0.31 (1)	10.00
AG-L	0/4107	-18.5	-18.5 0.31 (1)	10.00
L-AH	0/0	-18.5	-18.5 0.06 (4)	10.00
AH-AI	0/0	-18.5	-18.5 0.06 (4)	10.00
AI-K	0/0	-18.5	-18.5 0.06 (4)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
Q	5-10-8	-459	-	FRONT	VERT	TOTAL	-	C1
D	11-11-4	-110	-	FRONT	VERT	TOTAL	-	C1
F	17-11-4	-110	-	FRONT	VERT	TOTAL	-	C1
H	24-10-8	-459	-	FRONT	VERT	TOTAL	-	C1

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OSC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.03')
CALCULATED VERT. DEFL. (LL) = L/999 (0.13')
ALLOWABLE DEFL. (TL) = L/360 (1.03')
CALCULATED VERT. DEFL. (TL) = L/999 (0.24')

CSI: TC=0.27/1.00 (G-H-1), BC=0.47/1.00 (M-O-1),
WB=0.37/1.00 (L-I), SS=0.17/1.00 (G-H-1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION	(PSI)	(PL)	(PL)
MAX MIN MAX MIN MAX MIN			
MT20	618	354	1667 788 1987 1668

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (L) (INPUT = 0.90)
JSI METAL = 0.74 (K) (INPUT = 1.00)

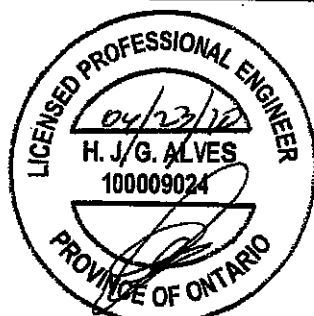

Structural component only
DWG# T-2006846 1/2

CONTINUED ON PAGE 2

JOB NAME 408320	TRUSS NAME T31	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tannerack Road Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 28 16:25:57 2020 Page 2
ID:7iLq53GdMK5i5Ctearm7D6zia3y-lu2Eh0tTp8CtHGU?P6TeydMJYx4QRF3p0EnVx0zNoEe

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B, I, K, Q					
B					
C	TTWW+m MT20	6.0	9.0	4.50	1.50
D	TMW+w MT20	3.0	6.0		
E	TMWW-t MT20	5.0	6.0		
F	TS-t MT20	5.0	6.0		
G	TMW+w MT20	3.0	6.0		
H	TTWW+m MT20	6.0	9.0	4.50	1.50
K	TMBMWVW1*+pMT20	6.0	12.0	7.75	2.75
L	BMWV-t MT20	5.0	6.0		
M	BMWVWV-t MT20	5.0	6.0		
N	BS-t MT20	5.0	6.0		
O	BMWVWV-t MT20	5.0	6.0		
P	BMWV-t MT20	5.0	6.0		
Q	TMBMWVW1*+pMT20	6.0	12.0	7.75	2.75

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
L	24-9-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
N	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
O	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
P	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
R	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
S	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
T	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	19-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	21-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	23-11-4	-113	-113	---	FRONT	VERT	TOTAL	---	C1
Y	2-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Z	4-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AA	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AB	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AC	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AD	17-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AE	19-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	21-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	23-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	26-8-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	28-8-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2006846 112

JOB NAME 408320	TRUSS NAME T31X	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRAWG NO.
Tamarack Roof Truss, Burlington				Version 8.910 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 08:02:58 2020 Page 2 ID:7fLq53GdMK5l5Qteanm7D6zia3y-IVXKofEg9RC3RwpHcaC HHIX9Vn8HAmLJfsozNaWD		

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
B	TTWW-m	MT20	7.0	8.0	3.25	2.25
C	TWW-w	MT20	3.0	6.0		
D	TWW-t	MT20	5.0	6.0		
E	TS-t	MT20	5.0	6.0		
F	TWW-w	MT20	3.0	6.0		
G	TTWW-m	MT20	6.0	9.0	3.00	2.50
H	TBMH-t	MT20	6.0	9.0	3.00	2.50
I	BWW-w	MT20	3.0	6.0		
J	BS-t	MT20	5.0	6.0		
K	BWW-w	MT20	5.0	9.0	2.50	2.25
L	BWW-t	MT20	5.0	12.0		
M	BWW-w	MT20	5.0	6.0		
N	BS-t	MT20	5.0	6.0		
O	BWW-t	MT20	5.0	6.0	2.50	3.75
P	TBMVW-t-p	MT20	7.0	12.0	7.75	3.00

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2006847 72

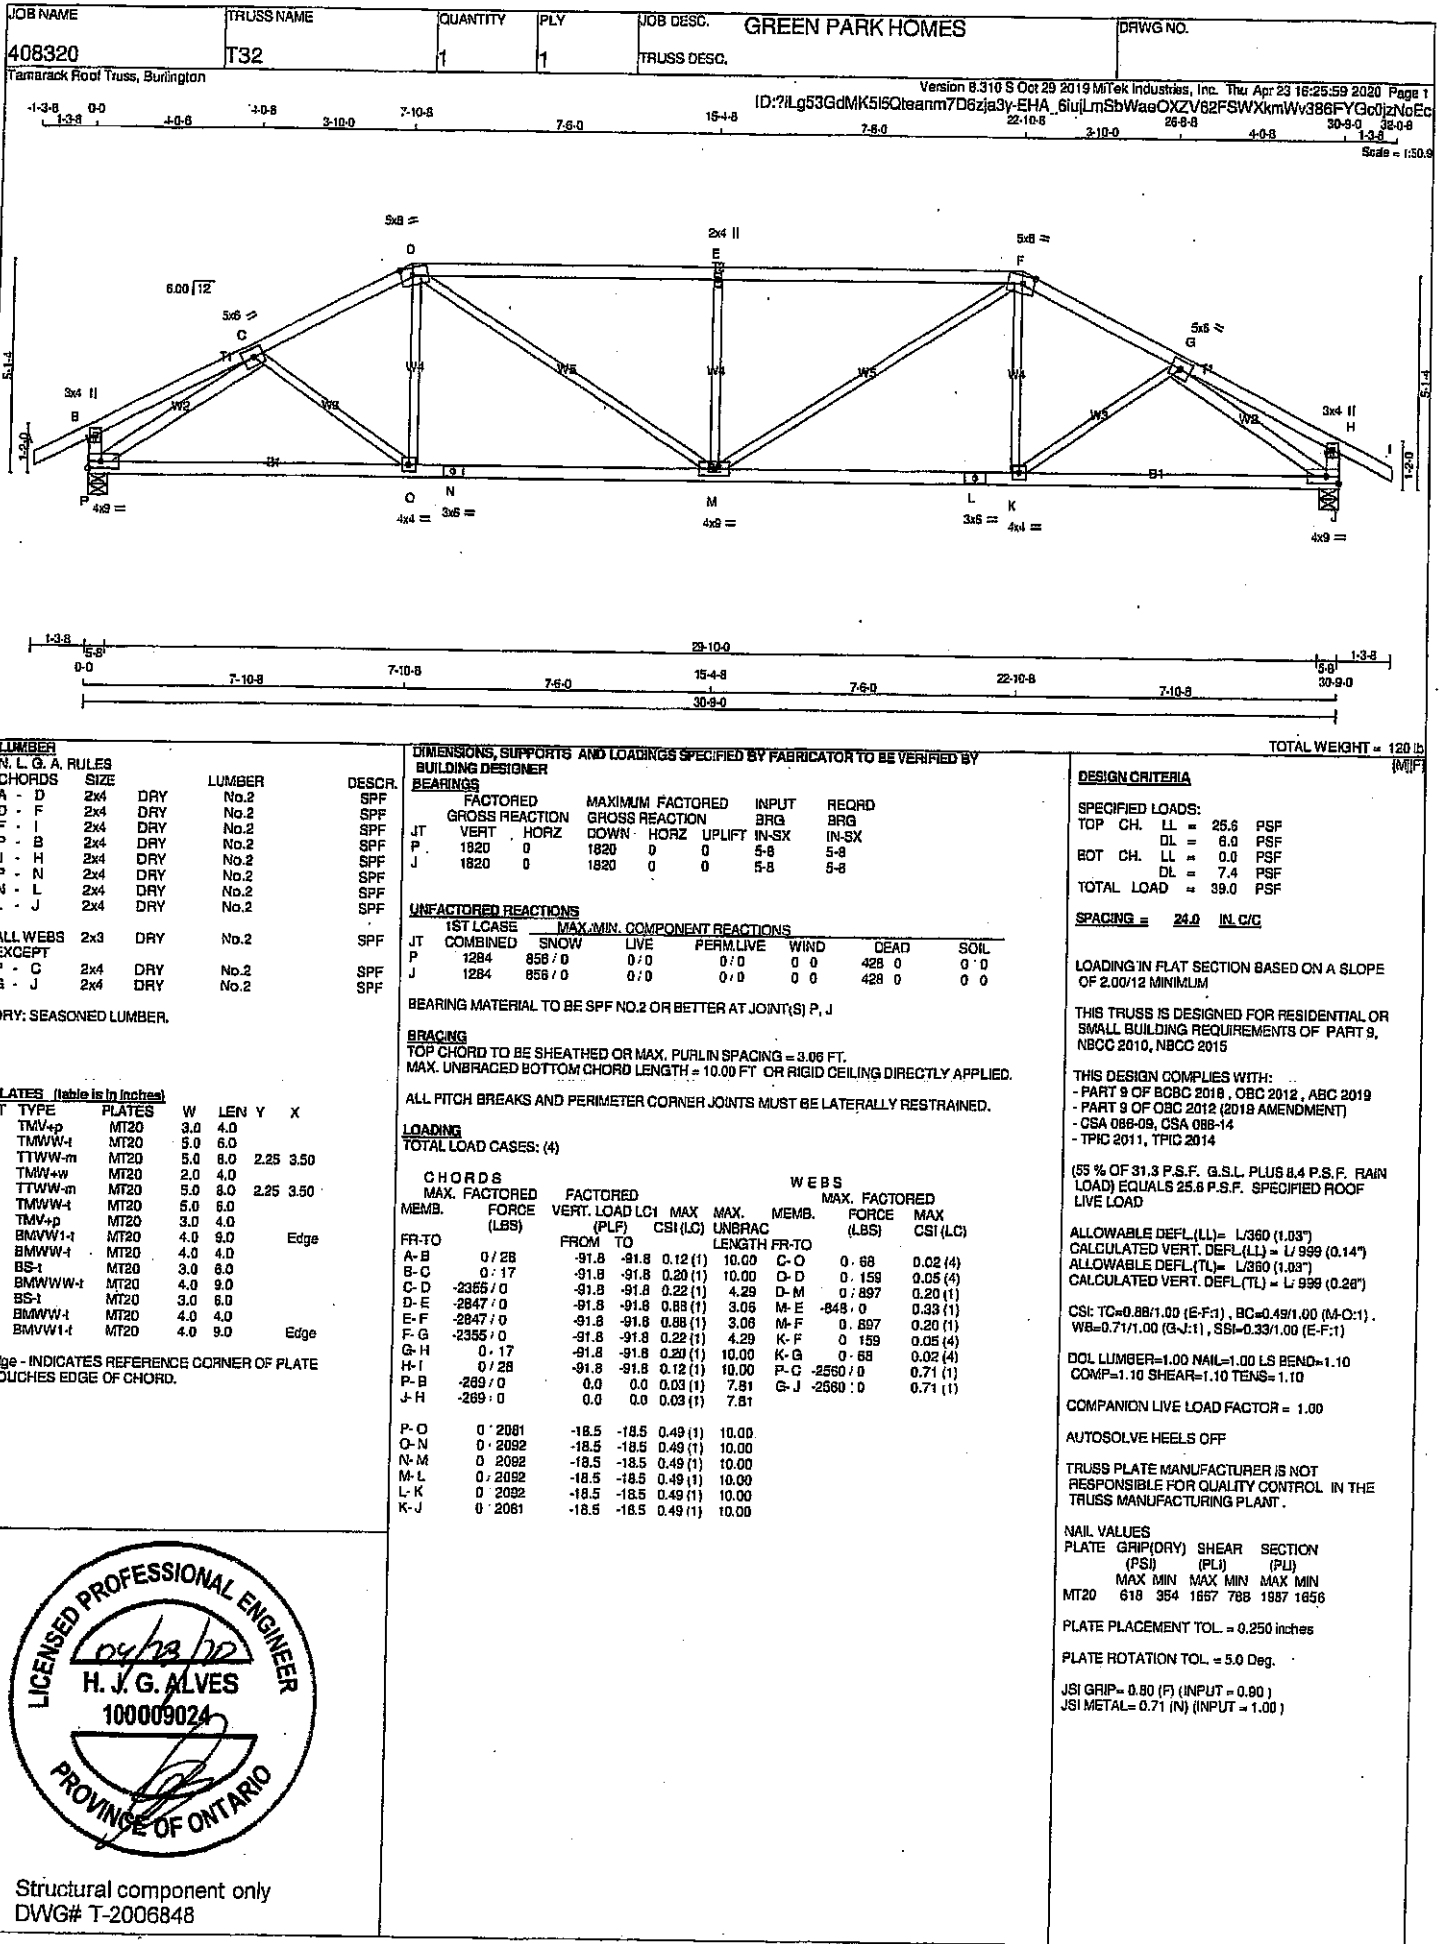

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408320	T32X	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Fri Apr 24 08:02:57 2020 Page 1

ID:71Lg53GdMK515Qleanm7D8zja3y-Bi4i1aFlwKw24O1rL5RWUqIsZtotfgvZzPPAEzNaWC



Scale = 1/50.5

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2		SPF
D - F	2x4	DRY	No.2		SPF
F - H	2x4	DRY	No.2		SPF
H - I	2x4	DRY	No.2		SPF
I - M	2x6	DRY	No.2		SPF
O - M	2x4	DRY	No.2		SPF
M - K	2x4	DRY	No.2		SPF
K - I	2x4	DRY	No.2		SPF
ALL WEBS	2x3	DRY	No.2		SPF
EXCEPT					
O - C	2x4	DRY	No.2		SPF
G - I	2x4	DRY	No.2		SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+P	MT20	3.0	4.0		
C TMVW+I	MT20	5.0	6.0		
D TTWW+M	MT20	5.0	8.0	2.25	3.50
E TMVW+M	MT20	2.0	4.0		
F TTWW+M	MT20	5.0	8.0	2.25	3.75
G TMVW+I	MT20	5.0	6.0		
H TMVWV1+PMT20		8.0	9.0	2.50	3.75
J BMVW+I	MT20	4.0	4.0		
K BS+I	MT20	3.0	8.0		
L BMVWV1+I	MT20	4.0	9.0		
M BS+I	MT20	3.0	6.0		
N BMVW+I	MT20	4.0	4.0		
O BMVWV1+I	MT20	4.0	9.0		Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
VERT	DOWN	HORIZ	UPLIFT
IN-SX	IN-SX		
JT 1858 0	1858 0	0 0	5-8 5-8
O 1732 0	1732 0	0 0	4-8 4-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
0	1310	873 / 0	0 / 0	0 / 0	0 / 0	437 / 0	0 / 0
1	1225	804 / 0	0 / 0	0 / 0	0 / 0	421 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	C-N	0 / 72
B-C	0 / 17	-91.8	-91.8	0.20 (1)	10.00	N-D	0 / 153
C-D	-2422 / 0	-91.8	-91.8	0.23 (1)	4.24	D-L	0 / 963
D-E	-2964 / 0	-91.8	-91.8	0.30 (1)	2.99	L-E	-947 / 0
E-F	-2964 / 0	-91.8	-91.8	0.30 (1)	2.99	L-F	0 / 824
F-G	-2554 / 0	-91.8	-91.8	0.27 (1)	4.10	J-F	0 / 294
G-H	0 / 17	-91.8	-91.8	0.24 (1)	10.00	J-G	-208 / 3
H-I	-269 / 0	0.0	0.0	0.03 (1)	7.81	O-C	-2623 / 0
I-H	-174 / 0	0.0	0.0	0.01 (1)	7.81	G-I	-2855 / 0
O-N	0 / 2132	-18.5	-18.5	0.50 (1)	10.00		
N-M	0 / 2153	-18.5	-18.5	0.50 (1)	10.00		
M-L	0 / 2153	-18.5	-18.5	0.50 (1)	10.00		
L-K	0 / 2270	-18.5	-18.5	0.54 (1)	10.00		
K-J	0 / 2270	-18.5	-18.5	0.54 (1)	10.00		
J-I	0 / 2434	-18.5	-18.5	0.56 (1)	10.00		

TOTAL WEIGHT = 121 lb

(MP)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.8	PSF
	DL =	8.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD =		38.0	PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.05")
CALCULATED VERT. DEFL.(LL) = L/899 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (1.05")
CALCULATED VERT. DEFL.(TL) = L/999 (0.29")

CS1: TC=0.90/1.00 (E-F:1), BC=0.56/1.00 (J-I:1), WB=0.98/1.00 (G-I:1), SS=0.33/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20 618 354	1667 788	1967 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.86 (D) (INPUT = 0.90)
JSI METAL = 0.78 (K) (INPUT = 1.00)

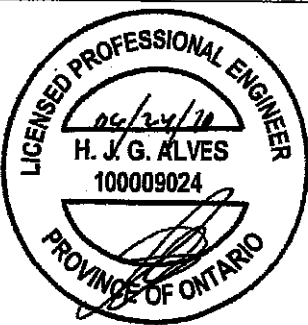

Structural component only
DWG# T-2006849


JOB NAME 408320	TRUSS NAME T33	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 16:28:01 2020 Page 1

ID:7iLg53GdMK5i5Clearnm7D6zja3y-BgikXOwzsNjmuome_Ya7qXz3YSEN1wPisil4bzNoEz

1-3-8 0-0 5-0-8 5-0-8 4-10-0 9-10-8 5-5-0 15-4-8 5-5-0 20-10-8 4-10-0 25-8-8 5-5-0 1-3-8 30-9-0 32-0-8 1-3-8
Scale = 1:50.0

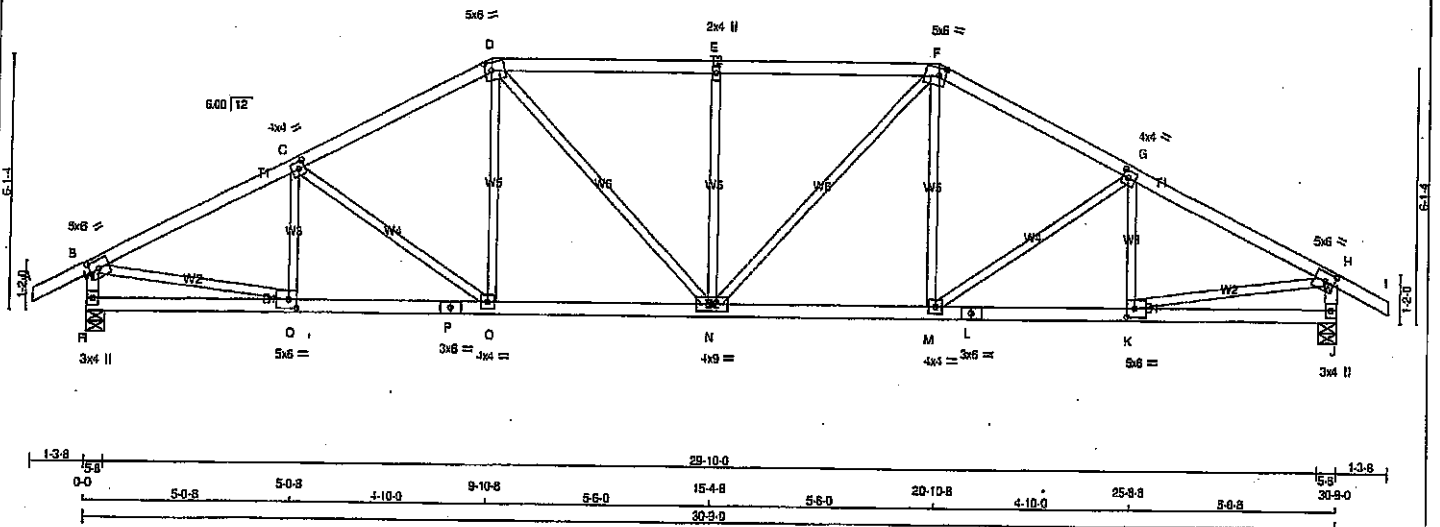

TOTAL WEIGHT = 2 X 120 = 240 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - S	2x4	DRY	No.2
S - H	2x4	DRY	No.2
H - P	2x4	DRY	No.2
P - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2

ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-1	MT20	5.0	6.0	2.50	2.75
C	TMWW-1	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	6.0	2.25	2.00
E	TMWW-w	MT20	2.0	4.0		
F	TTWW-w	MT20	5.0	6.0	2.25	2.00
G	TMWW-1	MT20	4.0	4.0	2.00	1.75
H	TMWW-1	MT20	5.0	6.0	2.50	2.75
J	BMV1-p	MT20	3.0	4.0		
K	BMWW-1	MT20	5.0	6.0	2.50	2.50
L	BS-1	MT20	3.0	6.0		
M	BMWW-1	MT20	4.0	4.0		
N	BMWW-1	MT20	4.0	9.0		
O	BMWW-1	MT20	4.0	4.0		
P	BS-1	MT20	3.0	8.0		
Q	BMWW-1	MT20	5.0	6.0	2.50	2.50
R	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED				MAXIMUM FACTORED			
GROSS REACTION				GROSS REACTION			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG
R	1820	0	1820	0	0	5-8	5-8
J	1820	0	1820	0	0	5-8	5-8

UNFACTORED REACTIONS							
1ST CASE							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1284	856 / 0	0 / 0	0 / 0	0 / 0	428 / 0	0 / 0
J	1284	856 / 0	0 / 0	0 / 0	0 / 0	428 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.09 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 28	-91.8 -91.8	0.12 (1)	10.00	Q-C	-282 / 0	
B-C	-2432 / 0	-91.8 -91.8	0.36 (1)	4.10	C-D	-283 / 0	
C-D	-2218 / 0	-91.8 -91.8	0.36 (1)	4.27	D-E	0 / 282	
D-E	-2304 / 0	-91.8 -91.8	0.43 (1)	4.09	E-F	0 / 492	
E-F	-2204 / 0	-91.8 -91.8	0.43 (1)	4.09	F-G	-617 / 0	
F-G	-2218 / 0	-91.8 -91.8	0.36 (1)	4.27	G-H	0 / 492	
G-H	-2432 / 0	-91.8 -91.8	0.36 (1)	4.10	H-I	0 / 282	
H-I	0 / 28	-91.8 -91.8	0.12 (1)	10.00	I-J	-283 / 0	
I-J	-1777 / 0	0.0 0.0	0.18 (1)	6.26	J-K	-282 / 0	
J-K	-1777 / 0	0.0 0.0	0.18 (1)	6.26	K-L	0 / 2227	
					L-M	0.50 (1)	
R-Q	0 / 0	-18.5 -18.5	0.10 (4)	10.00			
Q-P	0 / 2195	-18.5 -18.5	0.41 (1)	10.00			
P-O	0 / 2195	-18.5 -18.5	0.41 (1)	10.00			
O-N	0 / 1966	-18.5 -18.5	0.37 (1)	10.00			
N-M	0 / 1966	-18.5 -18.5	0.37 (1)	10.00			
M-L	0 / 2195	-18.5 -18.5	0.41 (1)	10.00			
L-K	0 / 2195	-18.5 -18.5	0.41 (1)	10.00			
K-J	0 / 0	-18.5 -18.5	0.10 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.02")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.02")
CALCULATED VERT. DEFL.(TL) = L/999 (0.21")

CSI: TC=0.43/1.00 (D-E:1), BC=0.41/1.00 (K-M:1), WB=0.50/1.00 (H-K:1), SS=0.24/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.65 (H) (INPUT = 1.00)




Structural component only
DWG# T-2006850

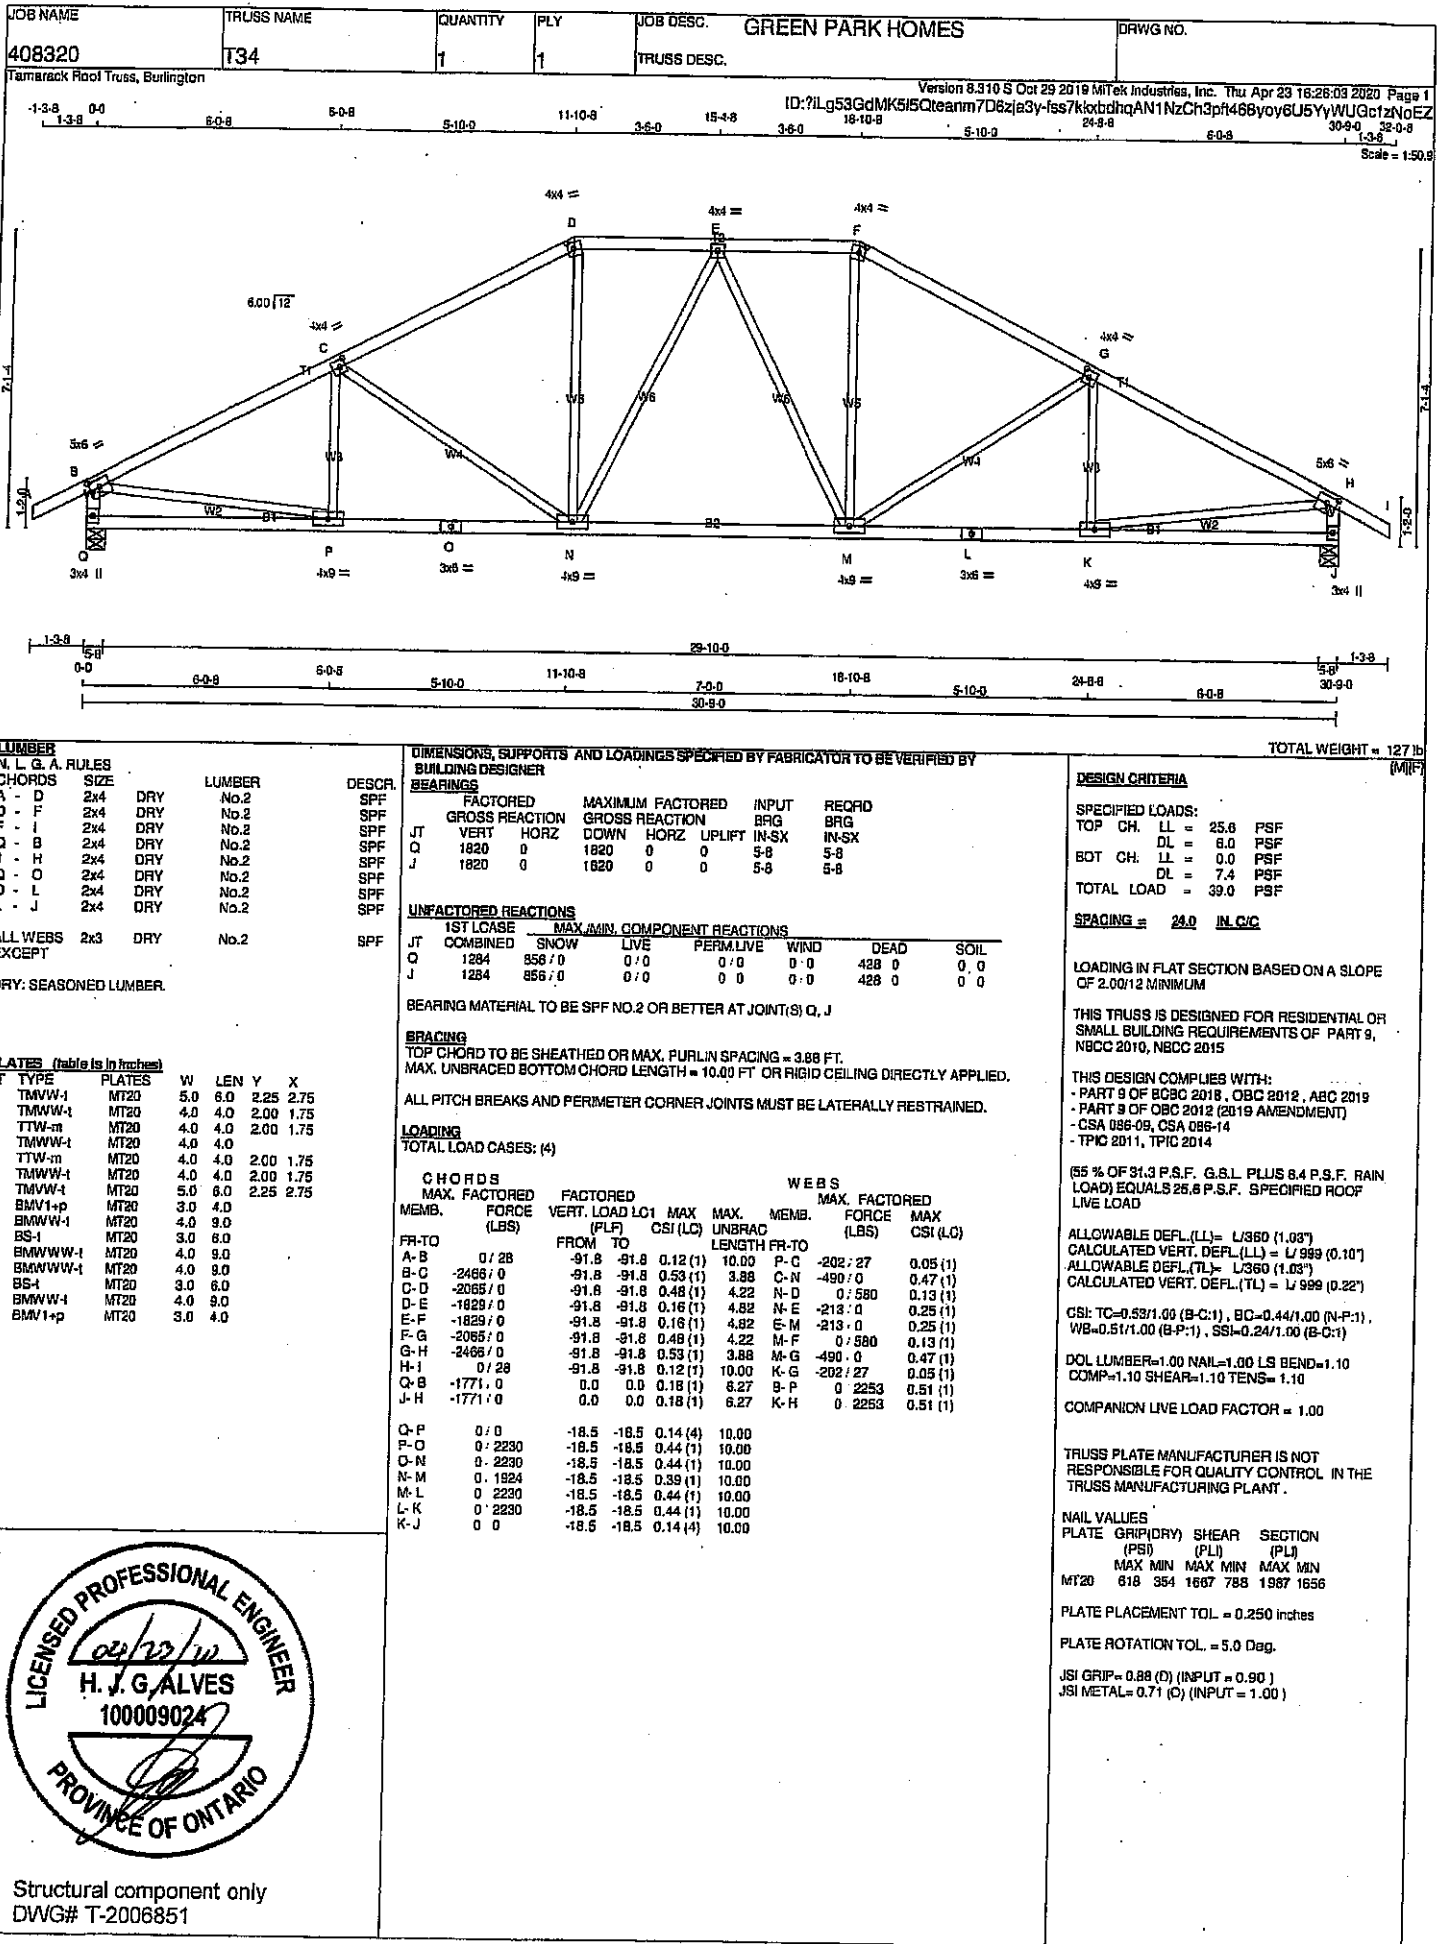

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408320	T34X	1	1	TRUSS DESC.		

Temerack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 08:02:58 2020 Page 1

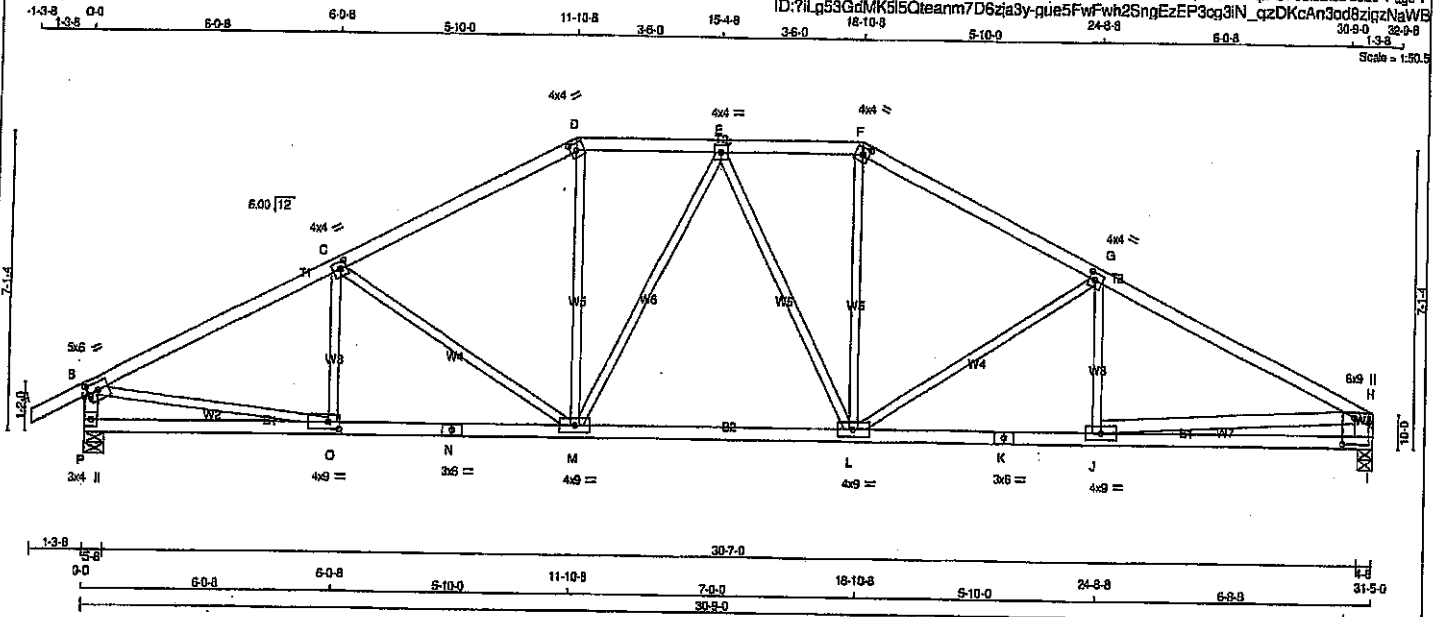

TOTAL WEIGHT = 130 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
P - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT	J - H	2x4	DRY
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	5.0	6.0	2.25
C	TMVW-1	MT20	4.0	4.0	2.00
D	TTW-H	MT20	4.0	4.0	2.00
E	TMVW-1	MT20	4.0	4.0	
F	TTW-H	MT20	4.0	4.0	2.00
G	TMVW-1	MT20	4.0	4.0	2.00
H	TMVW-1	MT20	4.0	4.0	2.00
I	TMVW-1	MT20	8.0	9.0	7.50
J	BMVW-1	MT20	4.0	8.0	
K	BS-1	MT20	3.0	6.0	
L	BMVW-1	MT20	4.0	9.0	
M	BMVW-1	MT20	4.0	9.0	
N	BS-1	MT20	3.0	8.0	
O	BMVW-1	MT20	4.0	9.0	2.00
P	BMV-1	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG					
P	1858	0	1858	0	0	5-8	5-8		
I	1732	0	1732	0	0	4-8	4-8		
UNFACTORED REACTIONS									
1ST CASE	MAX. MIN. COMPONENT REACTIONS								
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
P	1310	873 / 0	0 / 0	0 / 0	0 / 0	437 / 0	0 / 0		
I	1225	804 / 0	0 / 0	0 / 0	0 / 0	421 / 0	0 / 0		
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I									
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.53 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.									

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS									
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORZ. LOAD (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	MAX. FACTORED HORZ. LOAD (LBS)
FR-TO						FR-TO			
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	C-C	-211 / 24	0.06 (1)	
B-C	-2529 / 0	-91.8	-91.8	0.54 (1)	3.83	C-M	-481 / 0	0.46 (1)	
C-D	-2137 / 0	-91.8	-91.8	0.49 (1)	4.16	M-D	0 / 611	0.14 (1)	
D-E	-1884 / 0	-91.8	-91.8	0.17 (1)	4.75	M-E	-253 / 0	0.30 (1)	
E-F	-1930 / 0	-91.8	-91.8	0.17 (1)	4.71	E-L	-172 / 0	0.20 (1)	
F-G	-2181 / 0	-91.8	-91.8	0.55 (1)	4.08	L-F	0 / 638	0.14 (1)	
G-H	-2745 / 0	-91.8	-91.8	0.69 (1)	3.53	L-G	-669 / 0	0.85 (1)	
P-B	-1807 / 0	0.0	0.0	0.18 (1)	6.22	J-G	-79 / 79	0.03 (4)	
I-H	-1678 / 0	0.0	0.0	0.11 (1)	7.63	B-O	0 / 2310	0.52 (1)	
P-O	0 / 0	-18.5	-18.5	0.14 (4)	10.00	J-H	0 / 2488	0.40 (1)	
O-N	0 / 2287	-18.5	-18.5	0.45 (1)	10.00				
N-M	0 / 2287	-18.5	-18.5	0.45 (1)	10.00				
M-L	0 / 2007	-18.5	-18.5	0.41 (1)	10.00				
L-K	0 / 2481	-18.5	-18.5	0.43 (1)	10.00				
K-J	0 / 2481	-18.5	-18.5	0.43 (1)	10.00				
J-I	0 / 0	-18.5	-18.5	0.17 (4)	10.00				

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL =	25.8 PSF
DL =	8.0 PSF
BOT CH. LL =	0.0 PSF
DL =	7.4 PSF
TOTAL LOAD =	39.0 PSF

SPACING = 21.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.05")
CALCULATED VERT. DEFL. (LL) = U/889 (0.11")
ALLOWABLE DEFL. (TL) = L/360 (1.05")
CALCULATED VERT. DEFL. (TL) = U/989 (0.24")

CSI: TC=0.69/1.00 (G-H:1), BC=0.48/1.00 (J-L:1), WS=0.65/1.00 (G-L:1), SS=0.26/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES					
PLATE	GRIP (DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
	MAX	MIN	MAX	MIN	MAX
MT20	618	354	1667	788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (B) (INPUT = 0.80)

JSI METAL= 0.76 (K) (INPUT = 1.00)

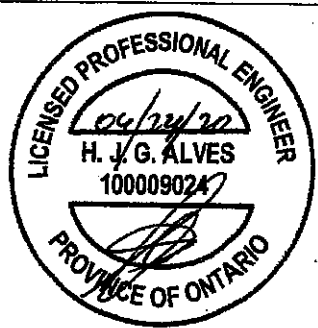

Structural component only
DWG# T-2008852


JOB NAME T35 **QUANTITY** 1 **PLY** 1 **GREEN PARK HOMES** **DRAWG NO.**

Famarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 16:26:05 2020 Page 1
ID:??Lg53GdMK5l5Qlsanm7D8zja3y-3RXFNzlUwcCIEV6XtqcWHWZS9pHJrp?eUjwDNzNoEW
1-3-8 0.0 7-0-8 7-0-8 6-10-0 13-10-8 3-0-0 16-10-8 6-10-0 23-8-8 7-0-8 30-9-0 1-3-8
Scale = 1:51.5

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.	SPF
A - D	2x4	DRY	No.2	SPF			
E - H	2x4	DRY	No.2	SPF			
I - J	2x4	DRY	No.2	SPF			
K - L	2x4	DRY	No.2	SPF			
M - N	2x4	DRY	No.2	SPF			
O - P	2x4	DRY	No.2	SPF			
Q - R	2x4	DRY	No.2	SPF			
S - T	2x4	DRY	No.2	SPF			
U - V	2x4	DRY	No.2	SPF			
W - X	2x4	DRY	No.2	SPF			
Y - Z	2x4	DRY	No.2	SPF			
AA - AB	2x4	DRY	No.2	SPF			
AC - AD	2x4	DRY	No.2	SPF			
AE - AF	2x4	DRY	No.2	SPF			
AG - AH	2x4	DRY	No.2	SPF			
AI - AJ	2x4	DRY	No.2	SPF			
AK - AL	2x4	DRY	No.2	SPF			
AM - AN	2x4	DRY	No.2	SPF			
AO - AP	2x4	DRY	No.2	SPF			
AQ - AR	2x4	DRY	No.2	SPF			
AS - AT	2x4	DRY	No.2	SPF			
AU - AV	2x4	DRY	No.2	SPF			
AW - AX	2x4	DRY	No.2	SPF			
AY - AZ	2x4	DRY	No.2	SPF			
B1 - B2	2x4	DRY	No.2	SPF			
B3 - B4	2x4	DRY	No.2	SPF			
B5 - B6	2x4	DRY	No.2	SPF			
B7 - B8	2x4	DRY	No.2	SPF			
B9 - B10	2x4	DRY	No.2	SPF			
B11 - B12	2x4	DRY	No.2	SPF			
B13 - B14	2x4	DRY	No.2	SPF			
B15 - B16	2x4	DRY	No.2	SPF			
B17 - B18	2x4	DRY	No.2	SPF			
B19 - B20	2x4	DRY	No.2	SPF			
B21 - B22	2x4	DRY	No.2	SPF			
B23 - B24	2x4	DRY	No.2	SPF			
B25 - B26	2x4	DRY	No.2	SPF			
B27 - B28	2x4	DRY	No.2	SPF			
B29 - B30	2x4	DRY	No.2	SPF			
B31 - B32	2x4	DRY	No.2	SPF			
B33 - B34	2x4	DRY	No.2	SPF			
B35 - B36	2x4	DRY	No.2	SPF			
B37 - B38	2x4	DRY	No.2	SPF			
B39 - B40	2x4	DRY	No.2	SPF			
B41 - B42	2x4	DRY	No.2	SPF			
B43 - B44	2x4	DRY	No.2	SPF			
B45 - B46	2x4	DRY	No.2	SPF			
B47 - B48	2x4	DRY	No.2	SPF			
B49 - B50	2x4	DRY	No.2	SPF			
B51 - B52	2x4	DRY	No.2	SPF			
B53 - B54	2x4	DRY	No.2	SPF			
B55 - B56	2x4	DRY	No.2	SPF			
B57 - B58	2x4	DRY	No.2	SPF			
B59 - B60	2x4	DRY	No.2	SPF			
B61 - B62	2x4	DRY	No.2	SPF			
B63 - B64	2x4	DRY	No.2	SPF			
B65 - B66	2x4	DRY	No.2	SPF			
B67 - B68	2x4	DRY	No.2	SPF			
B69 - B70	2x4	DRY	No.2	SPF			
B71 - B72	2x4	DRY	No.2	SPF			
B73 - B74	2x4	DRY	No.2	SPF			
B75 - B76	2x4	DRY	No.2	SPF			
B77 - B78	2x4	DRY	No.2	SPF			
B79 - B80	2x4	DRY	No.2	SPF			
B81 - B82	2x4	DRY	No.2	SPF			
B83 - B84	2x4	DRY	No.2	SPF			
B85 - B86	2x4	DRY	No.2	SPF			
B87 - B88	2x4	DRY	No.2	SPF			
B89 - B90	2x4	DRY	No.2	SPF			
B91 - B92	2x4	DRY	No.2	SPF			
B93 - B94	2x4	DRY	No.2	SPF			
B95 - B96	2x4	DRY	No.2	SPF			
B							

JOB NAME 408320	TRUSS NAME T35X	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Yamack Roof Truss, Burlington				TRUSS DESC.	

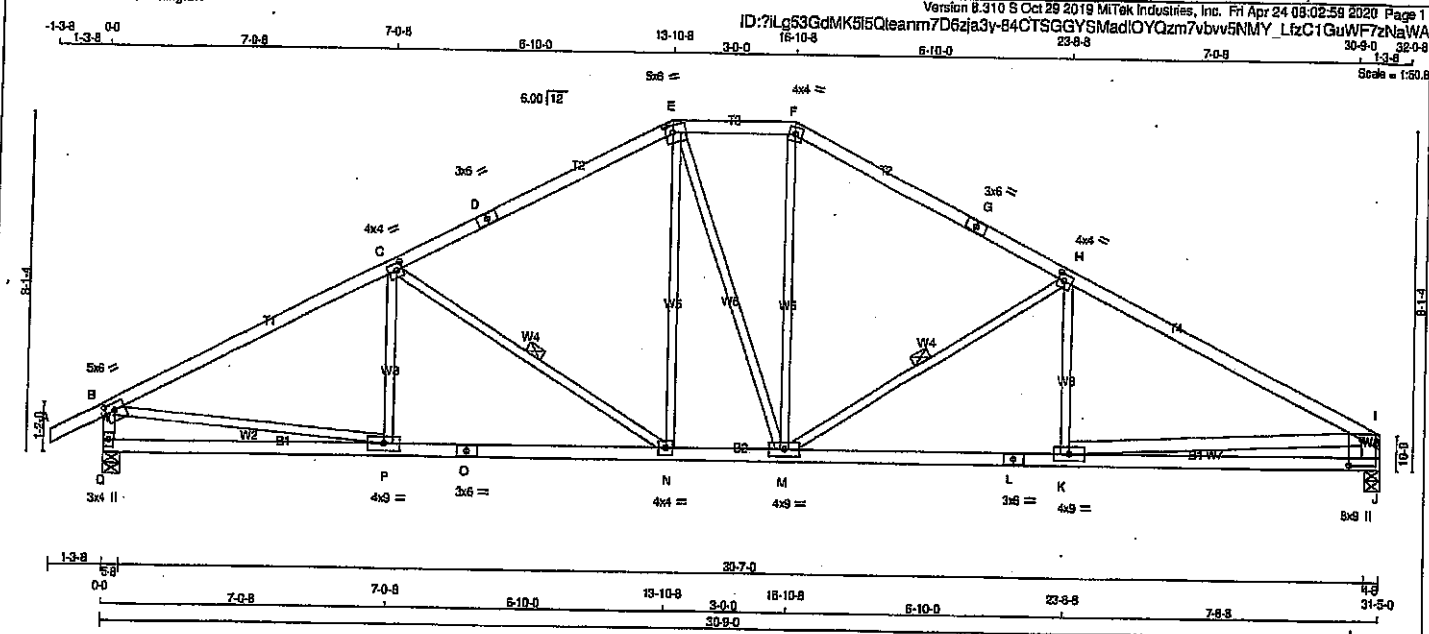

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
J - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - N	2x4	DRY	No.2
N - O	2x4	DRY	No.2
O - P	2x4	DRY	No.2
P - Q	2x4	DRY	No.2
ALL WEBS EXCEPT K - I	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	8.0	2.00	2.75
C	TMVW-t	MT20	4.0	4.0	2.00	1.75
D	TS-t	MT20	3.0	6.0		
E	TTWW-m	MT20	5.0	8.0	2.00	2.00
F	TTWW-m	MT20	4.0	4.0		
G	TS-t	MT20	3.0	6.0		
H	TMVW-t	MT20	4.0	4.0	2.00	1.75
I						
J	TMBMVW-t+p	MT20	8.0	9.0	7.50	3.75
K	BMVW-t	MT20	4.0	9.0		
L	BS-t	MT20	3.0	6.0		
M	BMVW-t	MT20	4.0	9.0		
N	BMVW-t	MT20	4.0	4.0		
O	BS-t	MT20	3.0	6.0		
P	BMVW-t	MT20	4.0	9.0		
Q	BMV-t+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	0/0	0/0
Q	HORZ	UP/LIFT	5-8	5-8
J	HORZ	UP/LIFT	4-8	4-8

UNFACTORED REACTIONS

	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
Q	1310	873/0 0/0 0/0 0/0 437/0 0/0
J	1225	804/0 0/0 0/0 0/0 421/0 0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.14 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, H-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/28	-91.8	-91.8 0.12 (1)	10.00	P-C	-135/73	0.04 (1)
B-C	-2538/0	-91.8	-91.8 0.77 (1)	3.50	C-N	-887/0	0.31 (1)
C-D	-1958/0	-91.8	-91.8 0.57 (1)	4.02	N-E	0/450	0.10 (1)
D-E	-1958/0	-91.8	-91.8 0.57 (1)	4.02	E-M	0/41	0.01 (1)
E-F	-1739/0	-91.8	-91.8 0.14 (1)	4.84	M-F	0/504	0.11 (1)
F-G	-1977/0	-91.8	-91.8 0.73 (1)	3.88	M-H	-856/0	0.39 (1)
G-H	-1977/0	-91.8	-91.8 0.73 (1)	3.88	K-H	-14/121	0.04 (4)
H-I	-2712/0	-91.8	-91.8 0.86 (1)	3.14	B-P	0/2317	0.52 (1)
Q-B	-1802/0	0.0	0.0 0.18 (1)	6.23	K-I	0/2462	0.40 (1)
J-I	-1672/0	0.0	0.0 0.11 (1)	7.64			
C-P	0/0	-18.5	-18.5 0.22 (4)	10.00			
P-O	0/2300	-18.5	-18.5 0.48 (1)	10.00			
O-N	0/2300	-18.5	-18.5 0.48 (1)	10.00			
N-M	0/1725	-18.5	-18.5 0.34 (1)	10.00			
M-L	0/2457	-18.5	-18.5 0.52 (1)	10.00			
L-K	0/2457	-18.5	-18.5 0.52 (1)	10.00			
K-J	0/0	-18.5	-18.5 0.25 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.05")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.05")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.24")

CSI: TC=0.96/1.00 (H-I:1), BC=0.52/1.00 (K-M:1), WB=0.52/1.00 (B-P:1), SS=0.30/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	818 854	1867 789

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.80 (F) (INPUT = 0.90)
JSI METAL=0.73 (L) (INPUT = 1.00)



JOB NAME Tamarack Roof Truss, Burlington
TRUSS NAME T36
QUANTITY 1
PLY 1
TRUSS DESC. GREEN PARK HOMES
DWG NO.

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 16:28:07 2020 Page 1
ID:7fLq53GdmK5l5Qlearm7D6za3y-7pf0oR_kSDSSUpFw?Fi_Mom72zUXnfpI5oC1IFzNoEU

LUMBER
N. L. G. A. RULES
CHORDS SIZE DRY LUMBER DESCR.
A - E 2x4 DRY No.2 SPF
E - F 2x4 DRY No.2 SPF
F - G 2x4 DRY No.2 SPF
G - K 2x4 DRY No.2 SPF
R - B 2x4 DRY No.2 SPF
L - J 2x4 DRY No.2 SPF
P - N 2x4 DRY No.2 SPF
V - L 2x4 DRY No.2 SPF
ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
I - C 2x4 DRY No.2 SPF
L 2x4 DRY No.2 SPF
DRY: SEASONED LUMBER.

PLATES (table in inches)
T TYPE PLATES W LEN Y X
TMW+p MT20 3.0 4.0
TMWW-I MT20 4.0 9.0
TMWW-I MT20 4.0 4.0 2.00 1.50
TS-I MT20 3.0 6.0
TTW+p MT20 4.0 6.0 Edge
TS-I MT20 3.0 6.0
TMWW-I MT20 4.0 4.0 2.00 1.50
TMWW-I MT20 4.0 9.0
TMW+p MT20 3.0 4.0
BMVVW-I MT20 4.0 9.0 Edge
BMWW-I MT20 4.0 4.0
BS-I MT20 3.0 6.0
BMWW-I MT20 4.0 4.0
BMVVW-I MT20 4.0 9.0 Edge
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DESIGNER'S SEAL:

STRUCTURAL COMPONENT ONLY
DWG# T-2006855

TOTAL WEIGHT = 129 lb

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN.C.C.
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015
THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014
[55% OF 31.3 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD] EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD
ALLOWABLE DEFL.(LL) = L/360 (1.02")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.02")
CALCULATED VERT. DEFL.(TL) = L/999 (0.21")
CSI: TC=0.33/1.00 (C-D:1), BC=0.48/1.00 (Q-R:1), WB=0.96/1.00 (D-C:1), SS=0.20/1.00 (B-C:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10
COMPANION LIVE LOAD FACTOR = 1.00
AUTOSOLVE HEELS OFF
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 788 1987 1656
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP = 0.88 (I) (INPUT = 0.50)
JSI METAL = 0.62 (N) (INPUT = 1.00)

BEARINGS
FACTORED MAXIMUM FACTORED INPUT REQ'D
GROSS REACTION GROSS REACTION BRG BRG
DOWN DOWN UPLIFT IN-SX IN-SX
JT 1820 0 1820 0 0 5-8 5-8
R 1820 0 1820 0 0 5-8 5-8
L 1820 0 1820 0 0 5-8 5-8

UNFACTORED REACTIONS
1ST LCASE MAX.MIN. COMPONENT REACTIONS
JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL
R 1284 856 / 0 0 / 0 0 0 428 / 0 0 / 0
L 1284 856 / 0 0 / 0 0 0 428 / 0 0 / 0

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.22 FT.
MAX. UNBRAVED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.
1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-R, I-L.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRAVED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)


CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
R-TO		FROM TO		O-F			
A-B	0 / 28	-91.8 -91.8	0.12 (1)	10.00	O-H	-570 / 0	0.86 (1)
B-C	0 / 19	-91.8 -91.8	0.30 (1)	10.00	M-I	-141 / 23	0.05 (1)
C-D	-3323 / 0	-91.8 -91.8	0.33 (1)	4.22	D-O	-570 / 0	0.86 (1)
D-E	-1736 / 0	-91.8 -91.8	0.31 (1)	4.76	C-Q	0 / 292	0.07 (1)
E-F	-1736 / 0	-91.8 -91.8	0.31 (1)	4.76	R-C	-2601 / 0	0.50 (1)
F-G	-1736 / 0	-91.8 -91.8	0.31 (1)	4.76	I-L	-2601 / 0	0.50 (1)
G-H	-1736 / 0	-91.8 -91.8	0.31 (1)	4.76			
H-I	-2323 / 0	-91.8 -91.8	0.33 (1)	4.22			
I-J	0 / 19	-91.8 -91.8	0.30 (1)	10.00			
J-K	0 / 28	-91.8 -91.8	0.12 (1)	10.00			
K-L	-318 / 0	0.0 0.0	0.03 (1)	7.81			
L-M	-318 / 0	0.0 0.0	0.03 (1)	7.81			
M-N	0 / 2164	-18.5 -18.5	0.48 (1)	10.00			
N-O	0 / 1965	-18.5 -18.5	0.45 (1)	10.00			
O-P	0 / 1965	-18.5 -18.5	0.45 (1)	10.00			
P-Q	0 / 1965	-18.5 -18.5	0.45 (1)	10.00			
Q-R	0 / 1965	-18.5 -18.5	0.45 (1)	10.00			
R-S	0 / 1965	-18.5 -18.5	0.45 (1)	10.00			
S-T	0 / 2164	-18.5 -18.5	0.48 (1)	10.00			

USI GRIP= 0.90 (C) (INPUT = 0.90)
USI METAL= 0.68 (M) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408320	T37	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Thu Apr 23 16:26:09 2020 Page 1

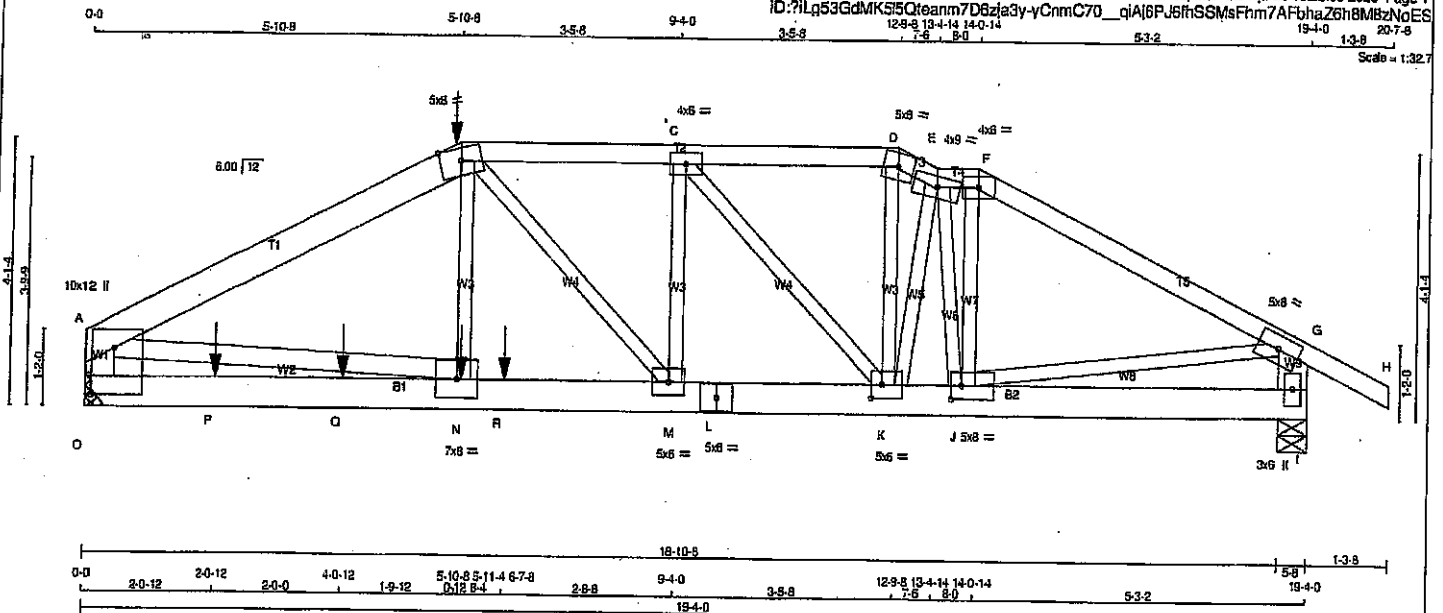

TOTAL WEIGHT = 100 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - B	2x6	DRY	No.2	SPF		
B - D	2x4	DRY	No.2	SPF		
D - E	2x4	DRY	No.2	SPF		
E - F	2x4	DRY	No.2	SPF		
F - H	2x4	DRY	No.2	SPF		
O - A	2x6	DRY	No.2	SPF		
I - G	2x6	DRY	No.2	SPF		
O - L	2x6	DRY	1650F 1.5E	SPF		
L - I	2x6	DRY	1650F 1.5E	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						
A - N	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMBMW1	MT20	10.0	12.0	8.50	4.50
B	TTWW-m	MT20	5.0	8.0	Edge	
C	TMWW-l	MT20	4.0	6.0		
D	TTW-m	MT20	5.0	6.0		
E	TTWW-m	MT20	4.0	9.0		
F	TTW-l	MT20	4.0	6.0		
G	TMBW-l	MT20	5.0	8.0		
I	BMW1-p	MT20	3.0	6.0		
J	BMWWW-l	MT20	5.0	8.0	2.50	2.00
K	BMWWW-l	MT20	5.0	8.0	2.50	2.00
L	BS-l	MT20	5.0	6.0		
M	BMWW-l	MT20	5.0	6.0		
N	BMWW-l	MT20	7.0	8.0		
O						

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	UP/LIFT	IN-SX
O	2573	0	2573	0
I	1933	0	1933	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT O. MINIMUM BEARING LENGTH AT JOINT O = 3-6.

UNFACTORED REACTIONS

1ST CASE	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	1814	1219	0	0	0	595	0
I	1361	927	0	0	0	434	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.45 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED MEMB. FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO		
A-B	-4080	-91.8	0.43 (1)	N-B	0	1150
B-C	-3448	-91.8	0.34 (1)	B-M	-297	0
C-D	-2545	-91.8	0.26 (1)	M-C	0	682
D-E	-2811	-91.8	0.10 (1)	C-K	-1348	0
E-F	-2401	-91.8	0.08 (1)	K-D	0	1097
F-G	-2825	-91.8	0.71 (1)	G-E	-168	0
G-H	0	-91.8	0.13 (1)	H-F	0	907
O-A	-2524	0	0.0	A-N	0	3641
I-G	-1875	0	0.0	G-J	0	2370
				J-E	-1142	0
O-P	0	-18.5	0.10 (4)			
P-Q	0	-18.5	0.10 (4)			
Q-R	0	-18.5	0.10 (4)			
R-M	0	-18.5	0.08 (1)			
M-L	0	-18.5	0.37 (1)			
L-K	0	-18.5	0.37 (1)			
K-J	0	-18.5	0.26 (1)			
J-I	0	-18.5	0.05 (4)			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
B	5-10-8	-459	-459	---	BACK	VERT	TOTAL	C1
N	5-11-4	-26	-26	---	BACK	VERT	TOTAL	C1
P	2-0-12	-26	-26	---	BACK	VERT	TOTAL	C1
Q	4-0-12	-26	-26	---	BACK	VERT	TOTAL	C1
R	6-7-8	-1712	-1712	---	BACK	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TFC 2011, TFC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.64")
CALCULATED VERT. DEFL. (LL) = L/899 (0.10")
ALLOWABLE DEFL. (TL) = L/360 (0.64")
CALCULATED VERT. DEFL. (TL) = L/999 (0.19")

CSI: TC=0.71/1.00 (F-G-1), BC=0.66/1.00 (M-N-1),
WB=0.64/1.00 (A-N-1), SS=0.94/1.00 (M-N-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (J) (INPUT = 0.80)
JSI METAL= 0.70 (S) (INPUT = 1.00)



Structural component only
DWG# T-2006857

JOB NAME 408320	TRUSS NAME T38	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 23 16:26:10 2020 Page 1	

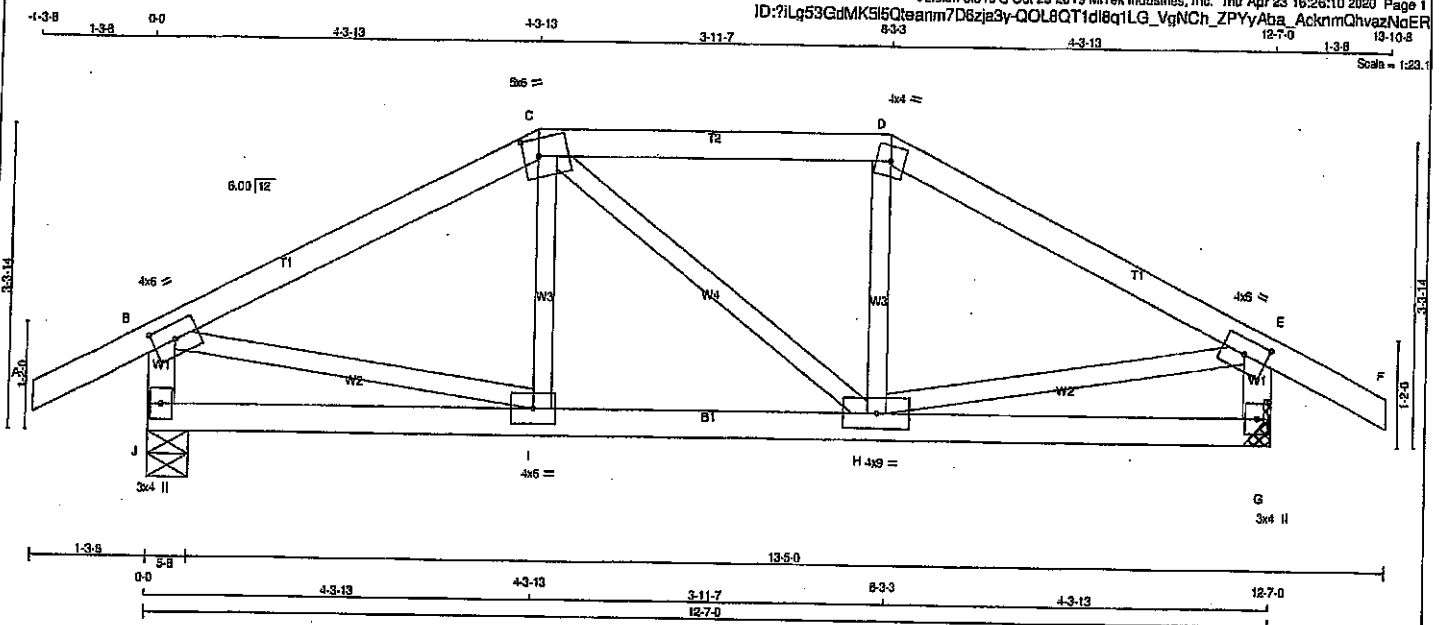

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE		LUMBER	DESCR.
A - C	2x4	DRY	No.2		SPF
C - D	2x4	DRY	No.2		SPF
D - F	2x4	DRY	No.2		SPF
J - B	2x4	DRY	No.2		SPF
G - E	2x4	DRY	No.2		SPF
J - G	2x4	DRY	No.2		SPF

ALL WEBS 2x3 DRY No.2
EXCEPT
SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B TMVW-t	MT20	4.0	6.0	2.00	3.00	
C TTWW-m	MT20	5.0	6.0	2.25	2.00	
D TTW-m	MT20	4.0	4.0			
E TMVW-t	MT20	4.0	6.0	2.00	3.00	
G BMV1-p	MT20	3.0	4.0			
H BMVW-t	MT20	4.0	9.0			
I BMVW-t	MT20	4.0	6.0			
J BMV1-p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
J	818	0	818	0
G	818	0	818	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS	1ST LCASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM LIVE WIND DEAD SOIL
J	576	391.0 0.0 0.0 0.0 185.0 0.0
G	576	391.0 0.0 0.0 0.0 185.0 0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J.

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0.28	-91.8 -91.8 0.12 (1)	I-C	-49.45 0.02 (4)
B-C	-740.0	-91.8 -91.8 0.23 (1)	C-H	0.2 0.00 (4)
C-D	-661.0	-91.8 -91.8 0.19 (1)	H-D	-46.47 0.02 (4)
D-E	-743.0	-91.8 -91.8 0.23 (1)	B-I	0.673 0.15 (1)
E-F	0.28	-91.8 -91.8 0.12 (1)	H-E	0.676 0.15 (1)
J-B	-783.0	0.0 0.0 0.08 (1)		
G-E	-782.0	0.0 0.0 0.08 (1)		
J-I	0.0	-18.5 -18.5 0.07 (4)		
I-H	0.659	-18.5 -18.5 0.14 (1)		
H-G	0.0	-18.5 -18.5 0.08 (4)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.42")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.42")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.23/1.00 (D-E:1), BC=0.14/1.00 (H-I:1), WB=0.15/1.00 (E-H:1), SS=0.14/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.44 (B) (INPUT = 0.90)
JSI METAL = 0.22 (E) (INPUT = 1.00)



Structural component only
DWG# T-2006858

JOB NAME 408320	TRUSS NAME T38Z	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Thu Apr 23 16:26:11 2020 Page 1					
ID: ?iLg53GdMK5l50teanm7D6zja3y-ubvWdo2FWSyuyQZhE4jwXnxhZawKb?10QAE0zNoEQ					

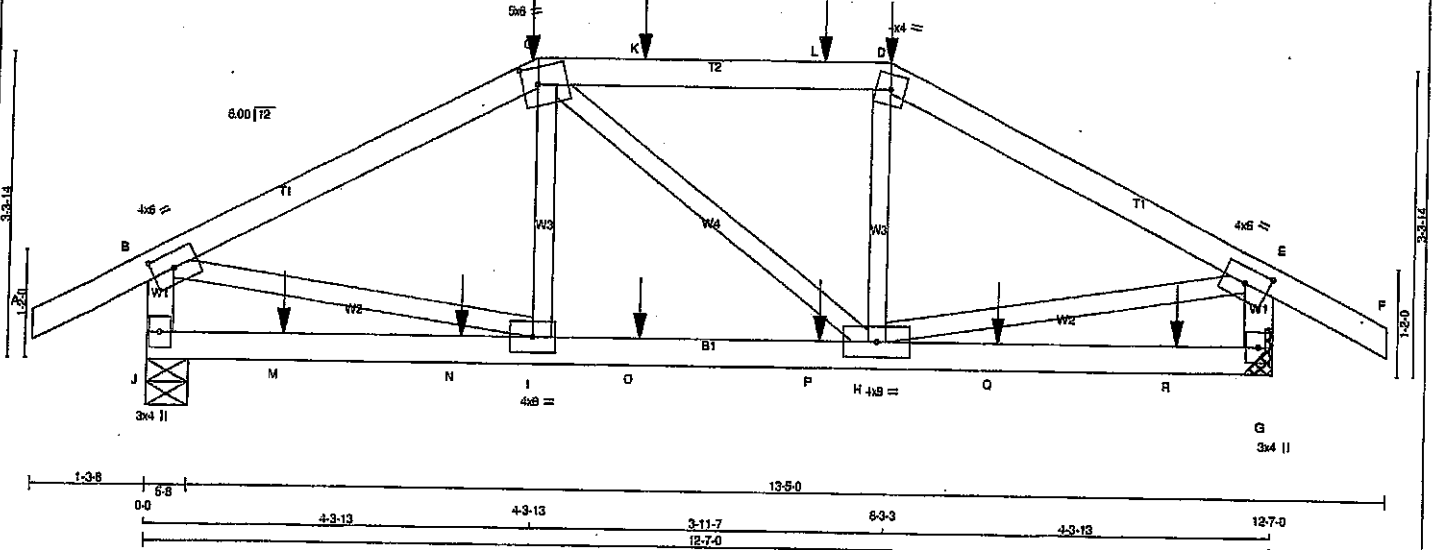

TOTAL WEIGHT = 50 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
J - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
J - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
S	TMVW-t	MT20	4.0	6.0	2.00 3.00
C	TTWV-m	MT20	5.0	6.0	2.25 2.00
D	TTWV-m	MT20	4.0	4.0	
E	TMVW-t	MT20	4.0	6.0	2.00 3.00
G	BMVt+p	MT20	3.0	4.0	
H	BMVWV-t	MT20	4.0	9.0	
I	BMVWV-t	MT20	4.0	6.0	
J	BMVt+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
JT	GROSS REACTION	FACTORED	MAXIMUM FACTORED	INPUT	REQD				
J	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	5-8	5-8
J	1108	0	1108	0	0	5-8	5-8		
G	1118	0	1118	0	0	MECHANICAL			

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS						
JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS				
J	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
J	780	531 / 0	0 / 0	0 / 0	0 / 0	249 / 0
G	788	534 / 0	0 / 0	0 / 0	0 / 0	252 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.33 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS									
MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LOC1	MAX	MAX.	MEMB.	MAX. FACTORED	MAX.
	(LBS)	(LBS)	(LBS)		(LBS)	(LBS)		(LBS)	(LBS)
FR-TO	FROM	TO	CSJ (LC)	UNBRAC	LENGTH	FR-TO	FROM	TO	CSJ (LC)
A-B	0 / 28	-91.8	-91.8	0.13 (1)	10.00	I-C	-101.53	0.02 (1)	
B-C	-1191 / 0	-91.8	-91.8	0.38 (1)	5.33	C-H	0.12	0.00 (1)	
C-K	-1070 / 0	-91.8	-91.8	0.38 (1)	5.56	H-D	-105.54	0.02 (1)	
K-L	-1070 / 0	-91.8	-91.8	0.38 (1)	5.58	B-I	0 / 1085	0.27 (1)	
L-D	-1070 / 0	-91.8	-91.8	0.38 (1)	5.58	H-E	0 / 1085	0.27 (1)	
D-E	-1205 / 0	-91.8	-91.8	0.38 (1)	5.33				
E-F	0 / 28	-91.8	-91.8	0.13 (1)	10.00				
J-B	-1084 / 0	0.0	0.0	0.12 (1)	7.61				
G-E	-1088 / 0	0.0	0.0	0.12 (1)	7.60				
J-M	0 / 0	-18.5	-18.5	0.11 (4)	10.00				
M-N	0 / 0	-18.5	-18.5	0.11 (4)	10.00				
N-I	0 / 0	-18.5	-18.5	0.11 (4)	10.00				
I-O	0 / 1061	-18.5	-18.5	0.23 (1)	10.00				
O-P	0 / 1061	-18.5	-18.5	0.23 (1)	10.00				
P-H	0 / 1061	-18.5	-18.5	0.23 (1)	10.00				
H-Q	0 / 0	-18.5	-18.5	0.11 (4)	10.00				
Q-R	0 / 0	-18.5	-18.5	0.11 (4)	10.00				
R-G	0 / 0	-18.5	-18.5	0.11 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LOC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-3-13	-38	-42	---	FRONT	VERT	DEAD	---	C1
C	4-3-13	-173	-173	---	FRONT	VERT	SNOW	---	C1
D	8-3-3	-38	-42	---	FRONT	VERT	DEAD	---	C1
D	8-3-3	-173	-173	---	FRONT	VERT	SNOW	---	C1
K	5-6-4	-42	-42	---	FRONT	VERT	TOTAL	---	C1
L	7-6-4	-53	-53	---	FRONT	VERT	TOTAL	---	C1
M	1-6-4	-12	-12	---	FRONT	VERT	TOTAL	---	C1
N	3-6-4	-12	-12	---	FRONT	VERT	TOTAL	---	C1
O	5-6-4	-12	-12	---	FRONT	VERT	TOTAL	---	C1
P	7-6-4	-12	-12	---	FRONT	VERT	TOTAL	---	C1
Q	9-6-4	-12	-12	---	FRONT	VERT	TOTAL	---	C1
R	11-6-4	-12	-12	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***

GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.

LOADS WERE DERIVED FROM USER INPUT

NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:			
TOP CH.	LL	=	25.6 PSF
	DL	=	6.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.4 PSF
TOTAL LOAD = 39.0 PSF			

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.42")

CALCULATED VERT. DEFL.(LL) = L/999 (0.02")

ALLOWABLE DEFL.(TL) = L/360 (0.42")

CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.39/1.00 (C-D:1), BC=0.23/1.00 (H-I:1), WB=0.27/1.00 (E-H:1), GS=0.20/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LBS SEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION	(PSI)	(PL)
	MAX	MIN	MAX	MIN	MAX
MT20	618	354	1667	788	1987

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.70 (I) (INPUT = 0.90)

JSI METAL= 0.34 (E) (INPUT = 1.00)




Structural component only
DWG# T-2006859

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408320	J31	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 8 Oct 29 2019 MTEK Industries, Inc. Thu Apr 23 16:25:51 2020 Page 1
ID:7iLg53GdMK515Cteanm7D6zja3y-TkhzRzoIDIRkZL1r3IMEJZ6JEW6H1cthxQJKBkzNoEk

Scale = 1:13.4

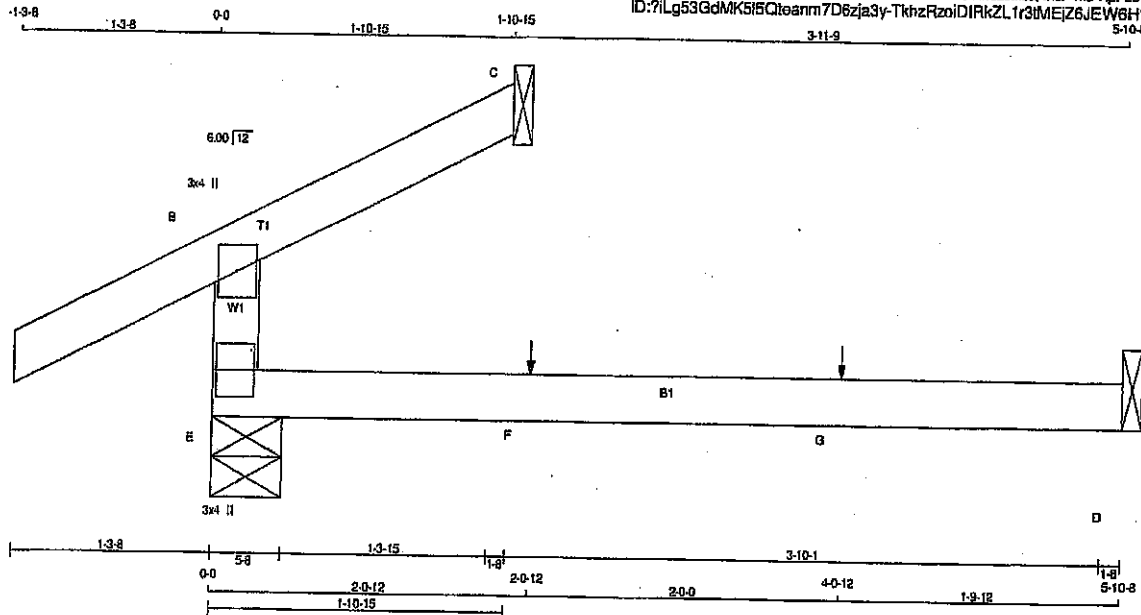

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
E	297	0	297	0
C	68	0	68	0
D	45	0	50	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) G, D

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM	WIND	DEAD	SOIL
E	212	130.0	0.0	0.0	0.0	82.0	0.0
C	48	37.0	0.0	0.0	0.0	9.0	0.0
D	36	0.0	0.0	0.0	0.0	38.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)
FR-TO						FR-TO		
E-B	-234.0	0.0	0.0	0.13 (4)	7.81	E-B	-234.0	0.0
A-B	0.28	-91.8	-91.8	0.12 (1)	10.00	A-B	0.28	-91.8
B-C	-10.0	-91.8	-91.8	0.08 (1)	10.00	B-C	-10.0	-91.8
E-F	0.0	-18.5	-18.5	0.13 (4)	10.00	E-F	0.0	-18.5
F-G	0.0	-18.5	-18.5	0.13 (4)	10.00	F-G	0.0	-18.5
G-D	0.0	-18.5	-18.5	0.13 (4)	10.00	G-D	0.0	-18.5

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
F	2-0-12	1	1	1	FRONT	VERT	TOTAL	---	C1
G	4-0-12	1	1	1	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 4 X 12 = 47 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")

CALCULATED VERT. DEFL.(LL) = L/999 (0.00")

ALLOWABLE DEFL.(TL) = L/360 (0.20")

CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.13/1.00 (B-E:4), BC=0.13/1.00 (D-E:4),

WB=0.00/1.00 (A-E:0), SS=0.09/1.00 (A-B:1)

DOL LUMBER=0.99 NAIL=0.99 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618	354	1887 785 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)

JSI METAL = 0.07 (B) (INPUT = 1.00)

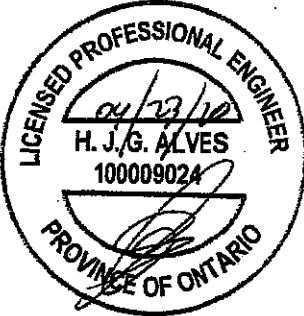


Structural component only
DWG# T-2006841

JOB NAME 408320	TRUSS NAME J33	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Road Truss, Burlington

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Thu Apr 29 16:25:53 2020 Page 1
ID:7iLg53GdMKS15Cteanm7D6zja3y-Q7pjsqylwhSofBEAIOid_CgvKqWVWnEtopHo3zNoEi

Scale = 1:12.5

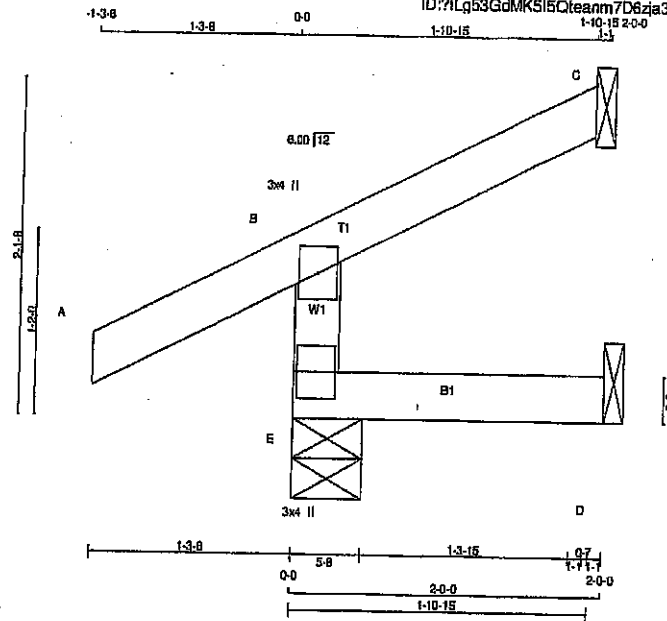

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HCRZ	DOWN	HCRZ		
E	254	0	254	0	5-8	5-8
C	66	0	66	0	1-8	1-8
D	16	0	16	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

JT	UNFACTORED REACTIONS		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
E	177	130.0	0.0	0.0	0.0	47.0	0.0
C	46	37.0	0.0	0.0	0.0	9.0	0.0
D	13	0.0	0.0	0.0	0.0	13.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS					WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. FACTORED CSI (LC)	MAX. UNBRACED LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO			FR-TO			
E-B	-234 / 0	0.0 0.0	0.01 (4)	7.81				
A-B	0 : 28	-91.8 -91.8	0.12 (1)	10.00				
B-C	-10 / 0	-91.8 -91.8	0.06 (1)	10.00				
E-D	0 / 0	-18.5 -18.5	0.02 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (A-D:0), SS=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 788 1957 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)

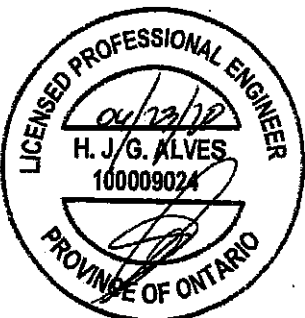


Structural component only
DWG# T-2006843

JOB NAME 408320	TRUSS NAME J34	QUANTITY 4	FLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Thu Apr 29 16:25:54 2020 Page 1
ID:2ILg53GdMK555Qteanm7D6zja3y-uJN53_qaWDpJQpmQk0wxLBlkpjAlEz0N6GYrKVzNoEh

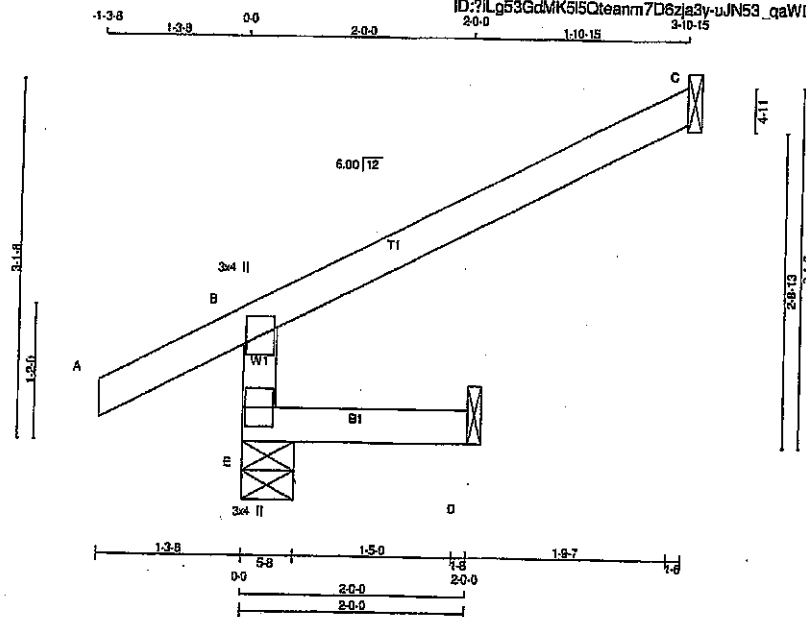

Scale = 1:18.5

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY, SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y
B	TMV+p	MT20	3.0	4.0	
E	BMV+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED				MAXIMUM FACTORED		INPUT	
GROSS REACTION				GROSS REACTION		BRG	
JT	VERT	HORZ		DOWN	HORZ	UPLIFT	IN-SX
E	389	0		389	0	0	5-8
C	135	0		135	0	0	1-8
D	18	0		18	0	0	1-8

SEE MITAK STANDARD DETAIL B97791 H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	255	194 / 0	0 / 0	0 / 0	0 / 0	62 / 0	0 / 0
C	93	75 / 0	0 / 0	0 / 0	0 / 0	18 / 0	0 / 0
D	13	0 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.		FACTORED		MEMB.		FACTORED	
FORCE (LBS)		VERT. LOAD LG1 MAX (PLF)		FORCE (LBS)		MAX (LBS)	
FR-TO		FROM TO		LENGTH FR-TO		CSI (LC)	
E-B	-349 / 0	0.0	0.0	0.01 (4)	7.81		
A-B	0 / 28	-91.8	-91.8	0.13 (5)	10.00		
B-C	-20 / 0	-91.8	-91.8	0.24 (1)	6.25		
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 4 X 10 = 38 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.24/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PL)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.15 (E) (INPUT = 0.90)
JSI METAL= 0.10 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006844

JOB NAME 408320	TRUSS NAME J36	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 5 Oct 2019 Mitek Industries, Inc. Thu Apr 23 18:25:55 2020 Page 1
ID:7ILg53GdMK5I5Qteanm7D6zja3y-MWXTGKtCHXx92zLcIjRAIPH_c7VKzQGXLwIOlyzNoEg

Scale = 1:10.2

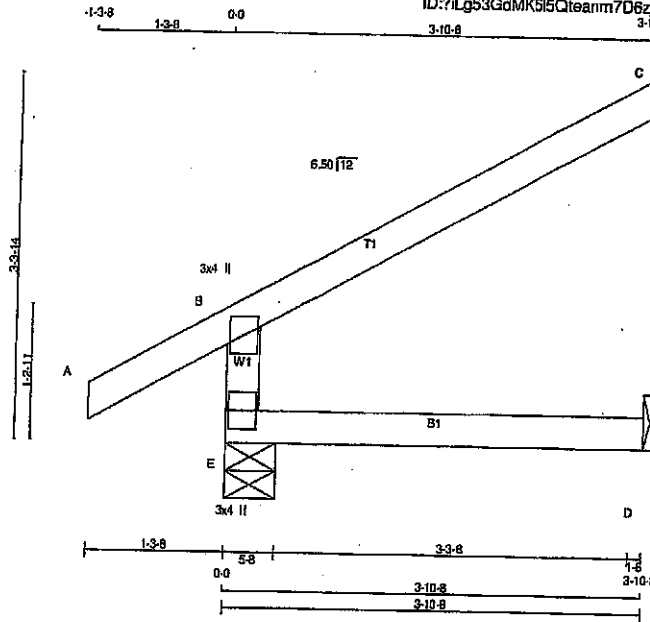

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	388	0	388	0	0	5-8	5-8
C	133	0	133	0	0	1-8	1-8
D	31	0	34	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	272	194.0	0.0	0.0	0.0	78.0	0.0
C	92	74.0	0.0	0.0	0.0	17.0	0.0
D	24	0.0	0.0	0.0	0.0	24.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (6)

CHORDS		FACTORED				WEBS		FACTORED			
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX	MAX	MEMB.	FORCE (LBS)	MAX	MAX	MAX	MAX
FR-TO		FROM	TO			FR-TO					
E-B	-347.0	0.0	0.0	0.05 (4)	7.81						
A-B	0.30	-91.8	-91.8	0.14 (5)	10.00						
B-C	-21.0	-91.8	-91.8	0.23 (1)	6.25						
E-D	0.0	-18.5	-18.5	0.06 (4)	10.00						

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 8 X 12 = 73 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCG 2015, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.23/1.00 (B-C:1), BC=0.06/1.00 (D-E:1), WB=0.00/1.00 (N/A:0), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 783 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.15 (E) (INPUT = 0.90)
JSI METAL = 0.10 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008845

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:

- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.




Double-Shear
Nailing
Top View




Double-Shear
Nailing
Side View;
Do not
bend tab




Dome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,580

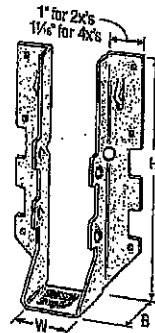


LUS28




LU26L

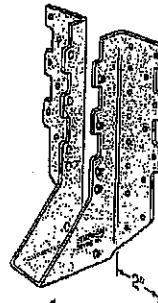


HUS210
(HUS26, HUS28,
and HHUS similar)



HGUS28-2




HHUS210-2



LJS26DS

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

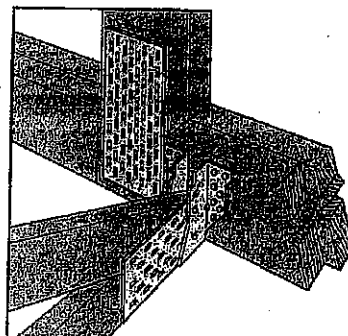

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options Information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
$W < 2"$	Bevel or square cut	0.62 of table value	0.46 of table value
$2" < W < 6"$	Bevel cut	0.67 of table value	0.41 of table value
$2" < W < 6"$	Square cut	0.46 of table value	0.41 of table value
$W > 6"$	Bevel cut	0.75 of table value	0.41 of table value

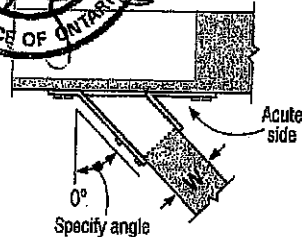

Top View HHUS Hanger Skewed Right
(joist must be bevel cut)
All joist nails installed on the outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ³	Header	Joist	D-Flt-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN	(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN
Single 2x Sizes											
LUS24	18	1 1/8	3 1/8	1 1/4	2 1/4	(4) 10d	(2) 10d	710 346	1625 7.23	645 2.87	1155 5.14
LU24L	22	1 1/8	3	1 1/8	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360 1.60	1020 4.54	320 1.42	725 3.22
LU26L	22	1 1/8	5	1 1/8	4 1/8	(6) 10d	(4) 10d x 1 1/2"	720 3.20	1605 7.14	645 2.87	1140 5.07
LUS26	18	1 1/8	4 3/8	1 1/4	3 3/4	(4) 10d	(4) 10d	1420 6.32	2170 9.65	1290 5.74	1630 7.25
HUS26	16	1 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	2705 11.80	4940 21.97	2065 9.20	3875 17.24
LJS26DS	18	1 1/8	5	3 1/2	4 1/8	(16) 16d	(6) 16d	2055 9.14	4265 18.97	1460 6.49	4115 18.31
HGUS26	12	1 1/8	6 1/8	5	4 1/4	(20) 16d	(8) 16d	2685 11.96	6625 29.51	2685 11.96	5700 25.35
LU28L	20	1 1/8	6 3/8	1 1/8	5 1/8	(8) 10d	(6) 10d x 1 1/2"	1140 5.07	2185 9.72	1020 4.54	1550 6.89
LUS28	18	1 1/8	6 1/8	1 1/4	3 3/4	(6) 10d	(4) 10d	1420 6.32	2520 11.21	1290 5.74	1790 7.96
HUS28	16	1 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3605 16.04	5365 23.86	2675 11.90	4345 19.33
HGUS28	12	1 1/8	7 1/8	5	6 1/8	(36) 16d	(12) 16d	3310 14.74	7675 34.19	3310 14.74	6900 30.73
LU210L	20	1 1/8	8	1 1/8	7 1/8	(10) 10d	(6) 10d x 1 1/2"	1140 5.07	2495 11.10	1020 4.54	1770 7.87
LUS210	18	1 1/8	7 1/8	1 1/4	3 3/4	(8) 10d	(4) 10d	1420 6.32	2785 12.39	1290 5.74	2210 9.83

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply glider truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

SIMPSON
Strong-Tie

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance					
		W	H	B	d _a ²	Header	Joist	D.Fir-L		S-P-F			
								Uplift	Normal	Uplift	Normal		
								(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN	(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN		
Double 2x Sizes													
LUS24-2	18	3 3/8	3 3/8	2	1 1/4	(4) 16d	(2) 16d	835 3.71	2020 8.99	590 2.62	1435 6.38		
LUS26-2	18	3 3/8	4 1/8	2	4	(4) 16d	(4) 16d	1720 7.65	2595 11.54	1545 6.87	1920 8.54		
HHUS26-2	14	3 3/8	5 3/8	3	3 1/4	(14) 16d	(6) 16d	2850 12.68	7335 32.63	2065 9.20	5205 23.15		
HGUS26-2	12	3 3/8	5 3/8	4	4 1/4	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27		
LUS28-2	18	3 3/8	7	2	4	(6) 16d	(4) 16d	1720 7.65	3325 14.79	1545 6.87	2575 11.45		
HHUS28-2	14	3 3/8	7 3/8	3	6 1/8	(22) 16d	(8) 16d	3765 16.75	8940 39.77	2675 11.90	6345 28.22		
HGUS28-2	12	3 3/8	7 3/8	4	6 1/4	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99		
LUS210-2	18	3 3/8	9	2	6	(8) 16d	(6) 16d	2580 11.48	4500 20.02	2320 10.32	3195 14.21		
HHUS210-2	14	3 3/8	9 3/8	3	8	(30) 16d	(10) 16d	4670 20.77	9660 42.97	4235 18.84	7000 31.14		
HGUS210-2	12	3 3/8	9 3/8	4	8 1/4	(46) 16d	(16) 16d	6840 30.43	14015 62.34	4855 21.60	10270 45.69		
Triple 2x Sizes													
HGUS26-3	12	4 1/8	5 1/2	4	4 1/4	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27		
HGUS28-3	12	4 1/8	7 1/4	4	6 3/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99		
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	4670 20.77	9660 43.02	4235 18.84	7000 30.54		
HGUS210-3	12	4 1/8	9 1/4	4	8 3/8	(46) 16d	(16) 16d	6840 30.43	14015 62.34	4855 21.60	10270 45.69		
Quadruple 2x Sizes													
HGUS26-4	12	6 3/8	5 3/8	4	4 1/4	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27		
HGUS28-4	12	6 3/8	7 3/8	4	6 3/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99		
HHUS210-4	14	6 3/8	8 3/8	3	7 3/8	(30) 16d	(10) 16d	4670 20.77	9660 43.02	4235 18.84	7000 30.54		
HGUS210-4	12	6 3/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	6840 30.43	14015 62.34	4855 21.60	10270 45.69		
HGUS212-4	12	6 3/8	10 3/8	4	10 3/8	(56) 16d	(20) 16d	7640 33.98	14995 66.70	5425 24.13	10645 47.35		
HGUS214-4	12	6 3/8	12 3/8	4	11 3/8	(66) 16d	(22) 16d	10130 45.06	16400 72.95	7195 32.00	11645 51.80		
4x Sizes													
LUS46	18	3 3/8	4 3/8	2	3 3/8	(4) 16d	(4) 16d	1720 7.65	2595 11.54	1545 6.87	1920 8.54		
HHUS46	14	3 3/8	5 3/8	3	3 1/4	(14) 16d	(6) 16d	2540 11.30	7335 32.63	2065 9.20	5205 23.15		
HGUS46	12	3 3/8	5 3/8	4	4 3/8	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27		
LUS48	18	3 3/8	6 3/8	2	3 3/8	(6) 16d	(4) 16d	1720 7.65	3325 14.79	1545 6.87	2575 11.45		
HHUS48	14	3 3/8	7 3/8	3	6 3/8	(22) 16d	(8) 16d	3765 16.75	8940 39.77	2675 11.90	6345 28.22		
HGUS48	12	3 3/8	7 3/8	4	6 3/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99		
LUS410	18	3 3/8	8 3/8	2	5 3/8	(8) 16d	(6) 16d	2580 11.48	4500 20.02	2320 10.32	3195 14.21		
HGUS410	12	3 3/8	9	4	8 3/8	(46) 16d	(16) 16d	6840 30.43	14015 62.34	4855 21.60	10270 45.69		
HGUS412	12	3 3/8	10 3/8	4	10 3/8	(56) 16d	(20) 16d	7640 33.98	14995 66.70	5425 24.13	10645 47.35		
HGUS414	12	3 3/8	12 3/8	4	11 3/8	(66) 16d	(22) 16d	10130 45.06	16400 72.95	7195 32.00	11645 51.80		



Plated Truss Connectors

See footnotes
on p. 258.

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

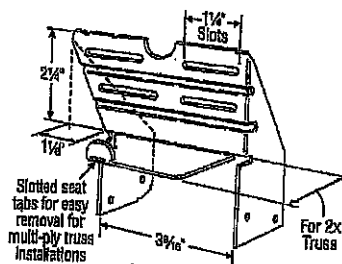


TC24
U.S. Patent 4,932,173

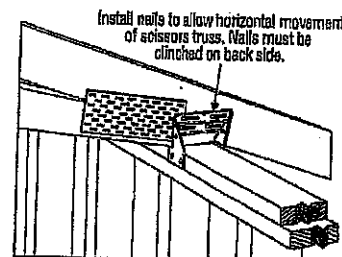


Typical TC24 Installation

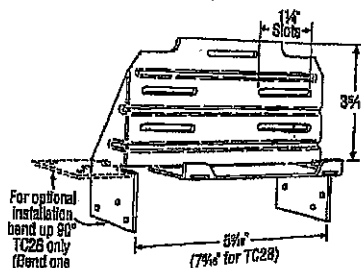

TC26
(TC28 Similar)

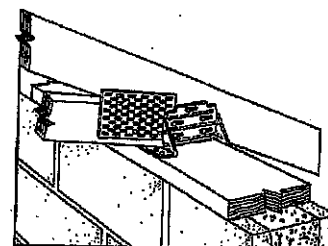

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer
(8", 10", 12" Wall Installation Similar)

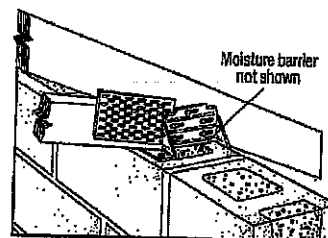

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _u =1.15)	Uplift (K _u =1.15)
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 70d	1015	720

Optional TC Installation Table


Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _u =1.15)	Uplift (K _u =1.15)
TC26	(5) 10d	(6) 10d x 1 1/2"	810	660
	(5) 10d	(6) 10d	930	680

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.

2. Grout strength is 15 MPa minimum.

3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.

4. TC26 fastened to grouted concrete block with (6) - 3/8" x 2 1/4" Titen screws has a factored uplift resistance of 276 lb.

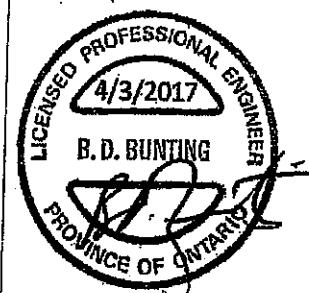

DESIGN

© 2007 Simpson Strong-Tie Company

SPF6-101-13 TC exp 6/10

(800) 999-5099
strongtie.com

H/TSP

SIMPSON
Strong-Tie

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_D = 1.15$)					
					D.Fir-L			S-P-F		
		To Rafters/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(6) 8d x 1 1/2"	(4) 8d	—	740	685	300	680	485	215
					3.29	3.05	1.33	3.02	2.16	0.96
SS H2A	18	(5) 8d x 1 1/2"	(2) 8d x 1 1/2"	(5) 8d x 1 1/2"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
					3.58	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	285	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(8) 8d	(8) 8d	1585	1065	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ³	18	(5) 10d x 1 1/2"	(5) 10d x 1 1/2"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A ³	18	(9) 10d x 1 1/2"	(9) 10d x 1 1/2"	—	1735	795	410	1505	565	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1 1/2"	(9) 10d x 1 1/2"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1 1/2"	(9) 10d x 1 1/2"	—	1835	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^{7a}	18	(8) 8d x 1 1/2"	(8) 8d x 1 1/2"	(8) 8d	1465	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2 1/2"	(6) 16d x 2 1/2"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	① (12) 8d x 1 1/2"	(13) 8d	—	2390	855	320	1805	610	230
		② (12) 8d x 1 1/2"	(15) 8d	—	10.63	3.80	1.42	8.03	2.71	1.02
					2390	855	320	1805	610	230
TSP	18	(9) 10d x 1 1/2"	(6) 10d x 1 1/2"	—	1295	440	—	920	310	—
					5.76	1.96	—	4.09	1.38	—
		(9) 10d x 1 1/2"	(5) 10d	—	1560	440	—	1105	310	—
					6.94	1.96	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2 1/2" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 8/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1 1/2" nails into the top plates and (3) 8d x 1 1/2" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2 1/2" = 0.162" dia. x 2 1/2" long, 10d = 0.148" dia. x 3" long, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long, 8d = 0.131" dia. x 2 1/2" long, 8d x 1 1/2" = 0.131" dia. x 1 1/2" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

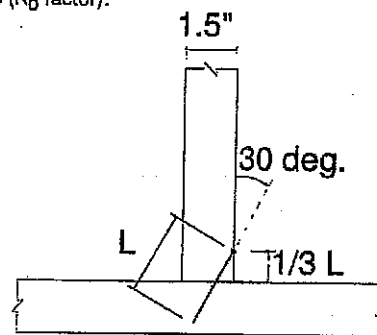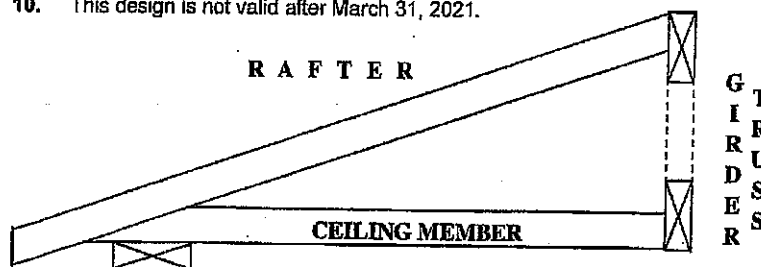


TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek

MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind or earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

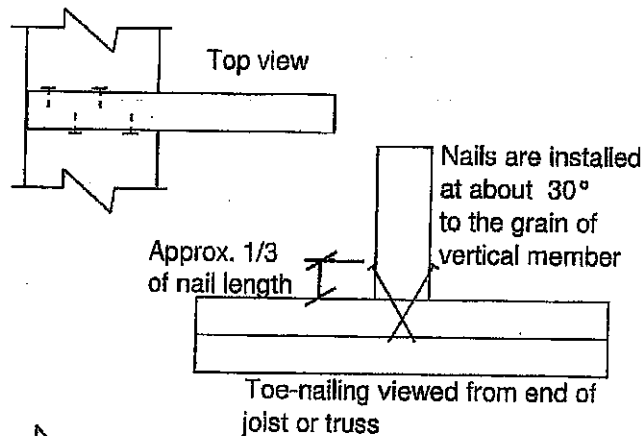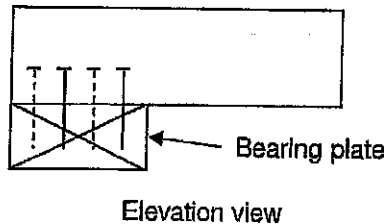

Toe-nailing on 2x4 Bearing Plate

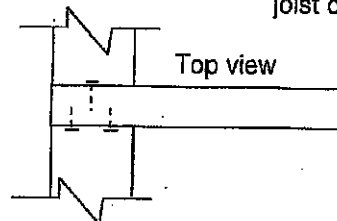




MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7



December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION




BEARING



Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

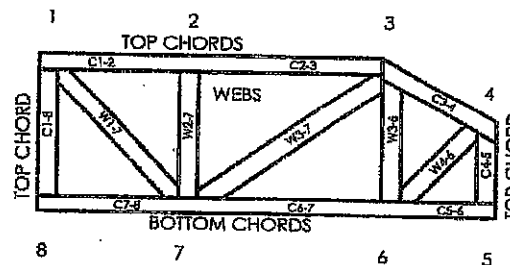

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MII-7473C rev. 10-'08



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

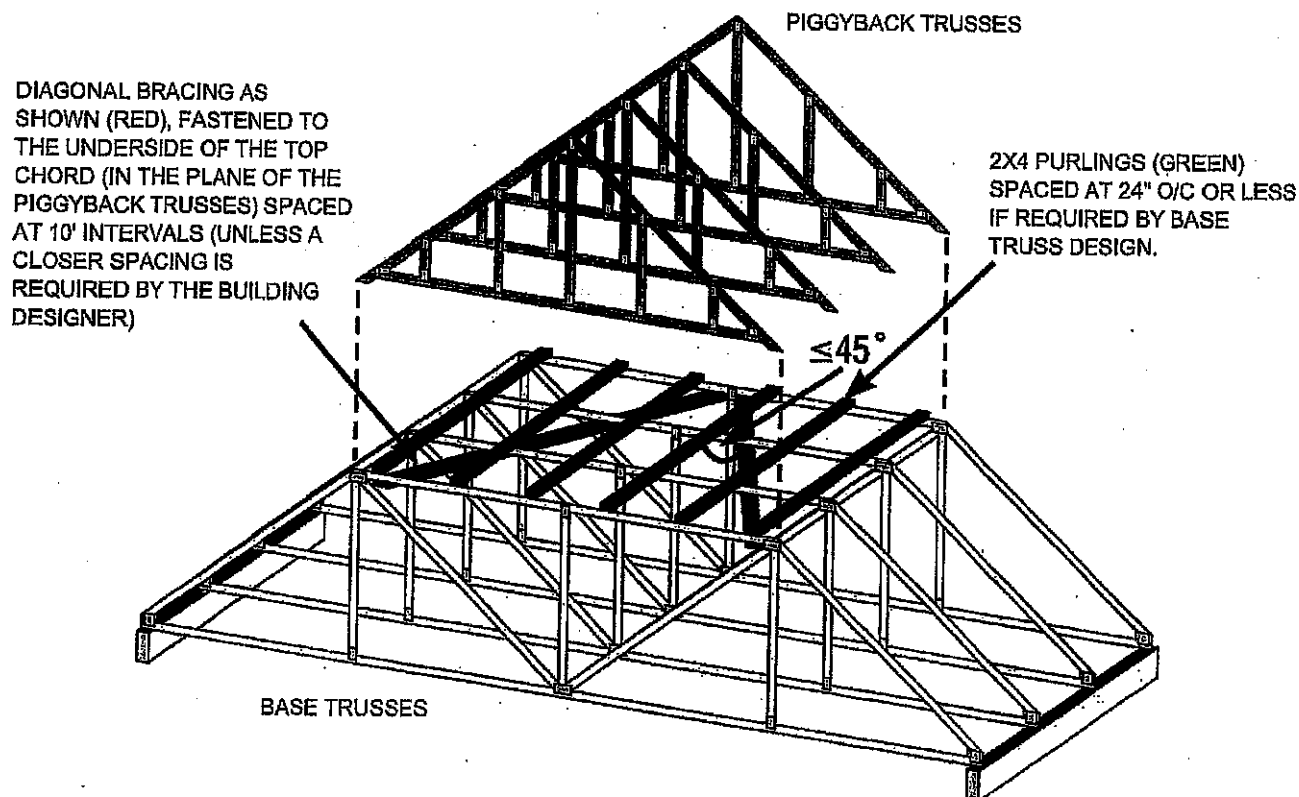

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components

2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.

3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.

4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.

5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.

2- Lumber is to be the sizes and grade specified on the truss drawing.

3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.

4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings

5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.

6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)

7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.

8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1800213

Feb 09, 2018