

SITE NAME: RUSSEL GARDENS PHASE 3

BUILDER: GREENPARK HOMES

TYPE: MOUNTAINASH 5

GFA: 3298

DATE: May-20

LO# 85969

WINTER NATURAL AIR CHANGE RATE 0.338

SUMMER NATURAL AIR CHANGE RATE 0.121

HEAT LOSS AT °F. 71

HEAT GAIN AT °F. 13

CSA-F280-12

SB-12 PACKAGE A1

ROOM USE	EXP. WALL	CLG. HT.	MBR	ENS	WIC	BED-2	BED-3	BED-4	ENS-2	FLEX	WIC-3	S-ENS		
			33	30	7	27	37	12	6	11	6	6		
			9	9	9	9	9	9	9	9	9	9		
GRS.WALL AREA	LOSS	GAIN	297	270	63	243	333	108	54	99	45	54		
GLAZING	LOSS	GAIN												
NORTH	19.8	15.1	0	0	0	14	277	212	0	0	0	0	0	0
EAST	19.8	39.0	0	0	0	0	0	0	48	949	1873	62	1226	2419
SOUTH	19.8	23.5	0	0	0	0	0	0	0	0	0	0	0	0
WEST	19.8	39.0	32	633	1248	14	277	546	0	0	0	0	0	0
SKYLT.	34.6	101.5	0	0	0	0	0	0	0	0	0	0	0	0
DOORS	23.5	4.3	0	0	0	0	0	0	0	0	0	0	0	0
NET EXPOSED WALL	4.1	0.8	265	1099	199	242	1003	182	63	261	47	182	755	137
NET EXPOSED BSMT WALL ABOVE GR	3.3	0.6	0	0	0	0	0	0	0	0	0	0	0	0
EXPOSED CLG	1.2	0.6	287	342	189	221	263	130	140	167	82	236	281	139
NO ATTIC EXPOSED CLG	2.6	1.3	0	0	0	0	0	0	0	0	0	0	0	0
EXPOSED FLOOR	2.4	0.4	0	0	0	0	0	0	0	0	0	0	0	0
BASEMENT/CRAWL HEAT LOSS			0	0	0	0	0	0	0	0	0	0	0	0
SLAB ON GRADE HEAT LOSS			0	0	0	0	0	0	0	0	0	0	0	0
SUBTOTAL HT LOSS			2073			1820			428			2654		
SUB TOTAL HT GAIN				1616		1070		130		2469		2787		
LEVEL FACTOR / MULTIPLIER	0.20	0.26		0.20	0.26		0.20	0.26		0.20	0.26		0.20	0.26
AIR CHANGE HEAT LOSS			537			471		111		739		895		236
AIR CHANGE HEAT GAIN				123		81		10		186		212		42
DUCT LOSS			0			0		0		358		0		0
DUCT GAIN			0			0		0		350		0		0
HEAT GAIN PEOPLE	240		2			480		0		0		0		0
HEAT GAIN APPLIANCES/LIGHTS						603		0		0		0		0
TOTAL HT LOSS BTU/H			2610			2292		539		3362		3377		1149
TOTAL HT GAIN x 1.3 BTU/H			3670			1497		161		5005		4895		1866

ROOM USE	EXP. WALL	CLG. HT.	FAM	L/D	K/B	L/H	LND	W/R	FOY	MUD			WOD	BAS
			36	30	37	18	12	18	18	30			46	180
			10	10	10	10	9	10	10	11			8	8
GRS.WALL AREA	LOSS	GAIN	360	300	370	190	108	180	180	330			368	1105
GLAZING	LOSS	GAIN												
NORTH	19.8	15.1	0	0	0	0	0	0	0	0	0	0	0	0
EAST	19.8	39.0	0	0	0	0	0	0	22	435	868	6	119	234
SOUTH	19.8	23.5	0	0	0	0	0	0	0	0	0	0	0	0
WEST	19.8	39.0	40	794	1561	0	0	0	0	0	0	0	0	0
SKYLT.	34.6	101.5	0	0	0	0	0	0	0	0	0	0	0	0
DOORS	23.5	4.3	0	0	0	0	0	0	0	0	0	0	0	0
NET EXPOSED WALL	4.1	0.8	320	1327	241	280	1078	195	310	1285	233	177	734	133
NET EXPOSED BSMT WALL ABOVE GR	3.3	0.6	0	0	0	0	0	0	0	0	0	0	0	0
EXPOSED CLG	1.2	0.6	0	0	0	0	0	0	0	0	0	0	0	0
NO ATTIC EXPOSED CLG	2.6	1.3	0	0	0	0	0	0	0	0	0	0	0	0
EXPOSED FLOOR	2.4	0.4	0	0	0	0	0	0	0	0	0	0	0	0
BASEMENT/CRAWL HEAT LOSS			0	0	0	0	0	0	0	0	0	0	0	0
SLAB ON GRADE HEAT LOSS			0	0	0	0	0	0	0	0	0	0	0	0
SUBTOTAL HT LOSS			2117			1669			2471			991		
SUB TOTAL HT GAIN				1801		1136		2674		438		346		
LEVEL FACTOR / MULTIPLIER	0.30	0.47		0.30	0.47		0.30	0.47		0.20	0.26		0.30	0.47
AIR CHANGE HEAT LOSS			997			880		1163		466		33		26
AIR CHANGE HEAT GAIN				137		86		196		0		0		0
DUCT LOSS			0			0		0		0		0		0
DUCT GAIN			0			0		0		0		0		0
HEAT GAIN PEOPLE	240		0			0		0		0		0		0
HEAT GAIN APPLIANCES/LIGHTS						603		603		603		603		603
TOTAL HT LOSS BTU/H			3114			2748		3634		1457		972		1603
TOTAL HT GAIN x 1.3 BTU/H			3304			2371		4385		1397		1268		1367

TOTAL HEAT GAIN BTU/H:

37122

TONS: 3.09

LOSS DUE TO VENTILATION LOAD BTU/H: 1816

STRUCTURAL HEAT LOSS: 53135

TOTAL COMBINED HEAT LOSS BTU/H: 54650

SITE NAME: RUSSEL GARDENS PHASE 3
BUILDER: GREENPARK HOMES

TYPE: MOUNTAINASH 5

DATE: May-20

GFA: 3298

LO# 85969

HEATING CFM	1131	✓	COOLING CFM	1131
TOTAL HEAT LOSS	53,135		TOTAL HEAT GAIN	36,848
AIR FLOW RATE CFM	21.29		AIR FLOW RATE CFM	30.69

furnace pressure	0.6
furnace filter	0.05
a/c coil pressure	0.2
available pressure for s/a & r/a	0.35

#GOODMAN
GMEC960603BNA 60

AFUE = 96 % L
INPUT (BTU/H) = 60,000
OUTPUT (BTU/H) = 57,600

DESIGN CFM = 1131
CFM @ .6" E.S.P.

TEMPERATURE RISE 47 °F

RUN COUNT	4th	3rd	2nd	1st	Bas
S/A	0	0	15	8	4
R/A	0	0	6	2	1

All S/A diffusers 4"x10" unless noted otherwise on layout

All S/A runs 5"Ø unless noted otherwise on layout

Run #	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
ROOM NAME	MBR	ENS	WIC	BED-2	BED-3	BED-4	ENS-2	FLEX	WIC-3	MBR	S-ENS	FAM	L/D	K/B	K/B	L/H	LND	W/R	FOY	MUD	BAS	BAS	BAS	BAS
RM LOSS MBH.	1.31	1.15	0.54	1.98	1.69	1.15	0.79	1.50	0.65	1.31	0.53	3.11	2.75	1.82	1.82	1.46	0.97	1.60	2.37	2.17	4.42	4.42	4.42	4.42
CFM PER RUN HEAT	28	24	11	42	36	24	17	32	14	28	11	68	59	39	39	31	21	34	50	46	94	94	94	94
RM GAIN MBH.	1.83	0.75	0.18	2.50	2.50	1.87	0.32	0.71	0.64	1.83	0.34	3.30	2.37	2.19	2.19	1.40	1.27	1.37	0.71	0.49	0.58	0.58	0.58	0.58
CFM PER RUN COOLING	56	23	6	77	77	57	10	22	20	56	10	101	73	67	67	43	39	42	22	15	18	18	18	18
ADJUSTED PRESSURE	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.16	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.16	0.16	0.16	0.16
ACTUAL DUCT LGH.	37	56	39	59	56	34	34	51	45	39	22	10	40	31	27	20	33	41	44	38	19	5	31	
EQUIVALENT LENGTH	190	160	150	130	170	200	220	160	110	130	150	140	130	150	160	140	180	110	90	140	140	120	140	130
TOTAL EFFECTIVE LENGTH	227	216	189	189	226	234	254	211	155	169	189	162	140	190	191	167	200	143	131	184	178	139	145	161
ADJUSTED PRESSURE	0.08	0.08	0.09	0.09	0.08	0.07	0.07	0.08	0.11	0.1	0.09	0.1	0.12	0.09	0.09	0.1	0.09	0.12	0.13	0.09	0.09	0.12	0.11	0.1
ROUND DUCT SIZE	5	4	4	6	6	5	4	4	4	5	4	6	5	5	5	4	4	4	4	4	6	6	6	6
HEATING VELOCITY (ft/min)	206	275	126	214	184	176	195	367	161	206	126	337	433	286	286	356	241	390	574	528	479	479	479	479
COOLING VELOCITY (ft/min)	411	264	69	393	393	419	115	252	229	411	115	515	536	492	492	493	447	482	252	172	92	92	92	92
OUTLET GRILL SIZE	3X10	3X10	3X10	4X10	4X10	3X10	3X10	3X10	3X10	3X10	3X10	4X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	4X10	4X10	4X10	4X10
TRUNK	A	A	B	D	C	C	C	A	D	B	D	B	D	A	A	C	B	C	C	C	A	A	D	D

RUN #	25	26	27
ROOM NAME	BED-2	BED-3	ENS
RM LOSS MBH.	1.98	1.69	1.15
CFM PER RUN HEAT	42	36	24
RM GAIN MBH.	2.50	2.50	0.75
CFM PER RUN COOLING	77	77	23
ADJUSTED PRESSURE	0.17	0.17	0.17
ACTUAL DUCT L.G.H.	52	48	52
EQUIVALENT LENGTH	120	170	130
TOTAL EFFECTIVE LENGTH	172	218	182
ADJUSTED PRESSURE	0.1	0.08	0.09
ROUND DUCT SIZE	6	6	4
HEATING VELOCITY (ft/min)	214	184	275
COOLING VELOCITY (ft/min)	393	393	264
OUTLET GRILL SIZE	4X10	4X10	3X10
TRUNK	D	C	A

SUPPLY AIR TRUNK SIZE															RETURN AIR TRUNK SIZE																	
	TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT			VELOCITY (ft/min)		TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT			VELOCITY (ft/min)		TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT			VELOCITY (ft/min)									
TRUNK A	298	0.08	8.9	10	x	8	536		TRUNK G	0	0.00	0	0	x	8	0	TRUNK O	0	0.05	0	0	x	8	0								
TRUNK B	546	0.08	11.2	14	x	8	702		TRUNK H	0	0.00	0	0	x	8	0	TRUNK P	0	0.05	0	0	x	8	0								
TRUNK C	322	0.07	9.5	10	x	8	580		TRUNK I	0	0.00	0	0	x	8	0	TRUNK Q	0	0.05	0	0	x	8	0								
TRUNK D	584	0.07	11.9	16	x	8	657		TRUNK J	0	0.00	0	0	x	8	0	TRUNK R	0	0.05	0	0	x	8	0								
TRUNK E	0	0.00	0	0	x	8	0		TRUNK K	0	0.00	0	0	x	8	0	TRUNK S	0	0.05	0	0	x	8	0								
TRUNK F	0	0.00	0	0	x	8	0		TRUNK L	0	0.00	0	0	x	8	0	TRUNK T	0	0.05	0	0	x	8	0								
															TRUNK U	0	0.05	0	0	x	8	0	TRUNK V	0	0.05	0	0	x	8	0		
															TRUNK W	0	0.05	0	0	x	8	0	TRUNK X	1041	0.05	16	30	x	8	625		
																	TRUNK Y	695	0.05	13.8	22	x	8	569	TRUNK Z	445	0.05	11.6	16	x	8	501
																	DROP	1131	0.05	16.5	24	x	10	679								

RETURN AIR #	1	2	3	4	5	6	7	8											BR
	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	171		
AIR VOLUME	90	85	90	90	85	75	360	85	0	0	0	0	0	0	0	0	171		
PLENUM PRESSURE	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15		
ACTUAL DUCT LGH.	41	52	53	58	53	59	45	41	1	1	1	1	1	1	1	1	15		
EQUIVALENT LENGTH	185	195	165	165	215	265	165	190	0	0	0	0	0	0	0	0	150		
TOTAL EFFECTIVE LH	226	247	218	223	268	324	210	231	1	1	1	1	1	1	1	1	165		
ADJUSTED PRESSURE	0.07	0.06	0.07	0.07	0.06	0.05	0.07	0.06	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	0.09		
ROUND DUCT SIZE	5.9	6	5.9	5.9	6	6	9.9	6	0	0	0	0	0	0	0	0	7		
INLET GRILL SIZE	8	8	8	8	8	8	8	8	0	0	0	0	0	0	0	0	8		
	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
INLET GRILL SIZE	14	14	14	14	14	14	30	14	0	0	0	0	0	0	0	0	14		

TYPE: MOUNTAINASH 5
 SITE NAME: RUSSEL GARDENS PHASE 3

LO # 85969

RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

COMBUSTION APPLIANCES		9.32.3.1(1)
a)	☒ Direct vent (sealed combustion) only	
b)	☐ Positive venting Induced draft (except fireplaces)	
c)	☐ Natural draft, B-vent or induced draft gas fireplace	
d)	☐ Solid Fuel (including fireplaces)	
e)	☐ No Combustion Appliances	

HEATING SYSTEM	
☒ Forced Air	☐ Non Forced Air
☐ Electric Space Heat	

HOUSE TYPE		9.32.1(2)
☒ I	Type a) or b) appliance only, no solid fuel	
☐ II	Type I except with solid fuel (including fireplaces)	
☐ III	Any Type c) appliance	
☐ IV	Type I, or II with electric space heat	
☐	Other: Type I, II or IV no forced air	

SYSTEM DESIGN OPTIONS		O.N.H.W.P.
☐ 1	Exhaust only/Forced Air System	
☐ 2	HRV with Ducting/Forced Air System	
☒ 3	HRV Simplified/connected to forced air system	
☐ 4	HRV with Ducting/non forced air system	
☐	Part 6 Design	

TOTAL VENTILATION CAPACITY		9.32.3.3(1)
Basement + Master Bedroom	2 @ 21.2 cfm	42.4 cfm
Other Bedrooms	3 @ 10.6 cfm	31.8 cfm
Kitchen & Bathrooms	5 @ 10.6 cfm	53 cfm
Other Rooms	7 @ 10.6 cfm	74.2 cfm
Table 9.32.3.A.	TOTAL	201.4 cfm

PRINCIPAL VENTILATION CAPACITY REQUIRED		9.32.3.4.(1)
1 Bedroom	31.8	cfm
2 Bedroom	47.7	cfm
3 Bedroom	63.6	cfm
4 Bedroom	79.5	cfm
5 Bedroom	95.4	cfm
TOTAL	79.5	cfm

SUPPLEMENTAL VENTILATION CAPACITY		9.32.3.6.
Total Ventilation Capacity	201.4	cfm
Less Principal Ventl. Capacity	79.5	cfm
Required Supplemental Capacity	121.9	cfm

PRINCIPAL EXHAUST FAN CAPACITY	
Model:	VANEE 65H
Location:	BSMT
79.5 cfm	3.0 sones
☒ HVI Approved	

PRINCIPAL EXHAUST HEAT LOSS CALCULATION				
CFM	ΔT °F	FACTOR	% LOSS	
79.5 CFM	X	71 F	X	1.08 X 0.25

SUPPLEMENTAL FANS		PANASONIC		
Location	Model	cfm	HVI	Sones
ENS	FV-05-11VK1	50	☒	0.3
ENS-2	FV-05-11VK1	50	☒	0.3
S-ENS	FV-05-11VK1	50	☒	0.3
W/R	FV-05-11VK1	50	☒	0.3

HEAT RECOVERY VENTILATOR		9.32.3.11.
Model:	VANEE 65H	
155 cfm high	64 cfm low	
75 % Sensible Efficiency	☒ HVI Approved	
@ 32 deg F (0 deg C)		

LOCATION OF INSTALLATION	
Lot:	Concession
Township:	Plan:
Address	
Roll #	Building Permit #

BUILDER: GREENPARK HOMES	
Name:	
Address:	
City:	
Telephone #:	Fax #:

INSTALLING CONTRACTOR	
Name:	
Address:	
City:	
Telephone #:	Fax #:

DESIGNER CERTIFICATION	
I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.	
Name:	HVAC Designs Ltd.
Signature:	<i>Michael O'Rourke</i>
HRAI #	001820
Date:	May-20

CSA F280-12 Residential Heat Loss and Heat Gain Calculations
Formula Sheet (For Air Leakage / Ventilation Calculation)

LO#: 85969

Model: MOUNTAINASH 5

Builder: GREENPARK HOMES

Date: 05/05/2020

Volume Calculation
Air Change & Delta T Data
House Volume

Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)
Bsmt	1452	8	11616
First	1452	10	14520
Second	1846	9	16614
Third	0	9	0
Fourth	0	9	0
Total:			42,750.0 ft³
Total:			1210.5 m³

WINTER NATURAL AIR CHANGE RATE	0.338
SUMMER NATURAL AIR CHANGE RATE	0.121

Design Temperature Difference				
	Tin °C	Tout °C	ΔT °C	ΔT °F
Winter DTDh	22	-17	39	71
Summer DTDc	24	31	7	13

5.2.3.1 Heat Loss due to Air Leakage
6.2.6 Sensible Gain due to Air Leakage

$$HL_{airb} = LR_{airh} \times \frac{V_b}{3.6} \times DTD_h \times 1.2$$

0.338 x 336.26 x 39 °C x 1.2 = 5347 W

= 18244 Btu/h

$$HG_{salb} = LR_{atrc} \times \frac{V_b}{3.6} \times DTD_c \times 1.2$$

= 0.121 x 336.26 x 7 °C x 1.2 = 347 W

= 1185 Btu/h

5.2.3.2 Heat Loss due to Mechanical Ventilation
6.2.7 Sensible heat Gain due to Ventilation

$$HL_{pairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$$

80 CFM x 71 °F x 1.08 x 0.25 = 1515 Btu/h

$$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$$

80 CFM x 13 °F x 1.08 x 0.25 = 275 Btu/h

5.2.3.3 Calculation of Air Change Heat Loss for Each Room (Floor Multiplier Section)

$$HL_{airr} = \text{Level Factor} \times HL_{airbv} \times \{(HL_{agcr} + HL_{bgcr}) \div (HL_{agcleve1} + HL_{bgcleve1})\}$$

Level	Level Factor (LF)	HLairbv Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{level})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)
1	0.5	18,244	8,547	1.067
2	0.3		11,628	0.471
3	0.2		14,089	0.259
4	0		0	0.000
5	0		0	0.000

*HLairbv = Air leakage heat loss + ventilation heat loss

*For a balanced or supply only ventilation system HLairbv = 0

HEAT LOSS AND GAIN SUMMARY SHEET**MODEL:** MOUNTAINASH 5**BUILDER:** GREENPARK HOMES**SFQT:** 3298**LO#** 85969**SITE:** RUSSEL GARDENS PHASE 3**DESIGN ASSUMPTIONS**

HEATING	°F	COOLING	°F
OUTDOOR DESIGN TEMP.	1	OUTDOOR DESIGN TEMP.	88
INDOOR DESIGN TEMP.	72	INDOOR DESIGN TEMP. (MAX 75°F)	75

BUILDING DATA

ATTACHMENT:	DETACHED	# OF STORIES (+BASEMENT):	3
FRONT FACES:	EAST	ASSUMED (Y/N):	Y
AIR CHANGES PER HOUR:	3.57	ASSUMED (Y/N):	Y
AIR TIGHTNESS CATEGORY:	AVERAGE	ASSUMED (Y/N):	Y
WIND EXPOSURE:	SHELTERED	ASSUMED (Y/N):	Y
HOUSE VOLUME (ft³):	42750.0	ASSUMED (Y/N):	Y
INTERNAL SHADING:	BLINDS/CURTAINS	ASSUMED OCCUPANTS:	5
INTERIOR LIGHTING LOAD (Btu/h/ft²):	1.27	DC BRUSHLESS MOTOR (Y/N):	Y
FOUNDATION CONFIGURATION	BCIN_1	DEPTH BELOW GRADE:	5.5 ft
LENGTH: 54.0 ft	WIDTH: 36.0 ft	EXPOSED PERIMETER:	180.0 ft

2012 OBC - COMPLIANCE PACKAGE		Compliance Package A1	
Component		Nominal	Min. Eff.
Ceiling with Attic Space Minimum RSI (R)-Value		60	59.22
Ceiling Without Attic Space Minimum RSI (R)-Value		31	27.65
Exposed Floor Minimum RSI (R)-Value		31	29.80
Walls Above Grade Minimum RSI (R)-Value		22	17.03
Basement Walls Minimum RSI (R)-Value		20 ci	21.12
Below Grade Slab Entire surface > 600 mm below grade Minimum RSI (R)-Value		-	-
Edge of Below Grade Slab ≤ 600 mm Below Grade Minimum RSI (R)-Value		10	10
Heated Slab or Slab ≤ 600 mm below grade Minimum RSI (R)-Value		10	11.13
Windows and Sliding Glass Doors Maximum U-Value		0.28	-
Skylights Maximum U-Value		0.49	-
Space Heating Equipment Minimum AFUE		0.96	-
HRV Minimum Efficiency		75%	-
Domestic Hot Water Heater Minimum EF		0.8	-


INDIVIDUAL BCIN: 19669

MICHAEL O'ROURKE



Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280 ✓

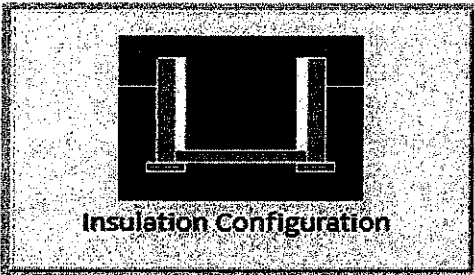Weather Station Description		
Province:	Ontario	
Region:	Hamilton	
Site Description		
Soil Conductivity:	Normal conductivity; dry sand, loam, clay	
Water Table:	Normal (7-10 m, 23-33 ft)	
Foundation Dimensions		
Floor Length (m):	16.5	 Insulation Configuration
Floor Width (m):	11.0	
Exposed Perimeter (m):	0.0	
Wall Height (m):	2.4	
Depth Below Grade (m):	1.68	
Window Area (m ²):	2.0	
Door Area (m ²):	1.9	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):	1658	


TYPE: MOUNTAINASH 5
LO# 85969

Air Infiltration Residential Load Calculator

Supplemental tool for CAN/CSA-F280 ✓



Weather Station Description				
Province:	Ontario			
Region:	Hamilton			
Weather Station Location:	Open flat terrain, grass			
Anemometer height (m):	10			
Local Shielding				
Building Site:	Suburban, forest			
Walls:	Heavy			
Flue:	Heavy			
Highest Ceiling Height (m):	7.62			
Building Configuration				
Type:	Detached			
Number of Stories:	Two			
Foundation:	Full			
House Volume (m ³):	1210.5			
Air Leakage/Ventilation				
Air Tightness Type:	Present (1961-) (3.57 ACH)			
Custom BDT Data:	ELA @ 10 Pa.	1613.7 cm ²		
	3.57	ACH @ 50 Pa		
Mechanical Ventilation (L/s):	Total Supply	Total Exhaust		
	37.5	37.5		
Flue Size				
Flue #:	#1	#2	#3	#4
Diameter (mm):	0	0	0	0
Natural Infiltration Rates				
Heating Air Leakage Rate (ACH/H):	0.338			
Cooling Air Leakage Rate (ACH/H):	0.121			

TYPE: MOUNTAINASH 5
LO# 85969

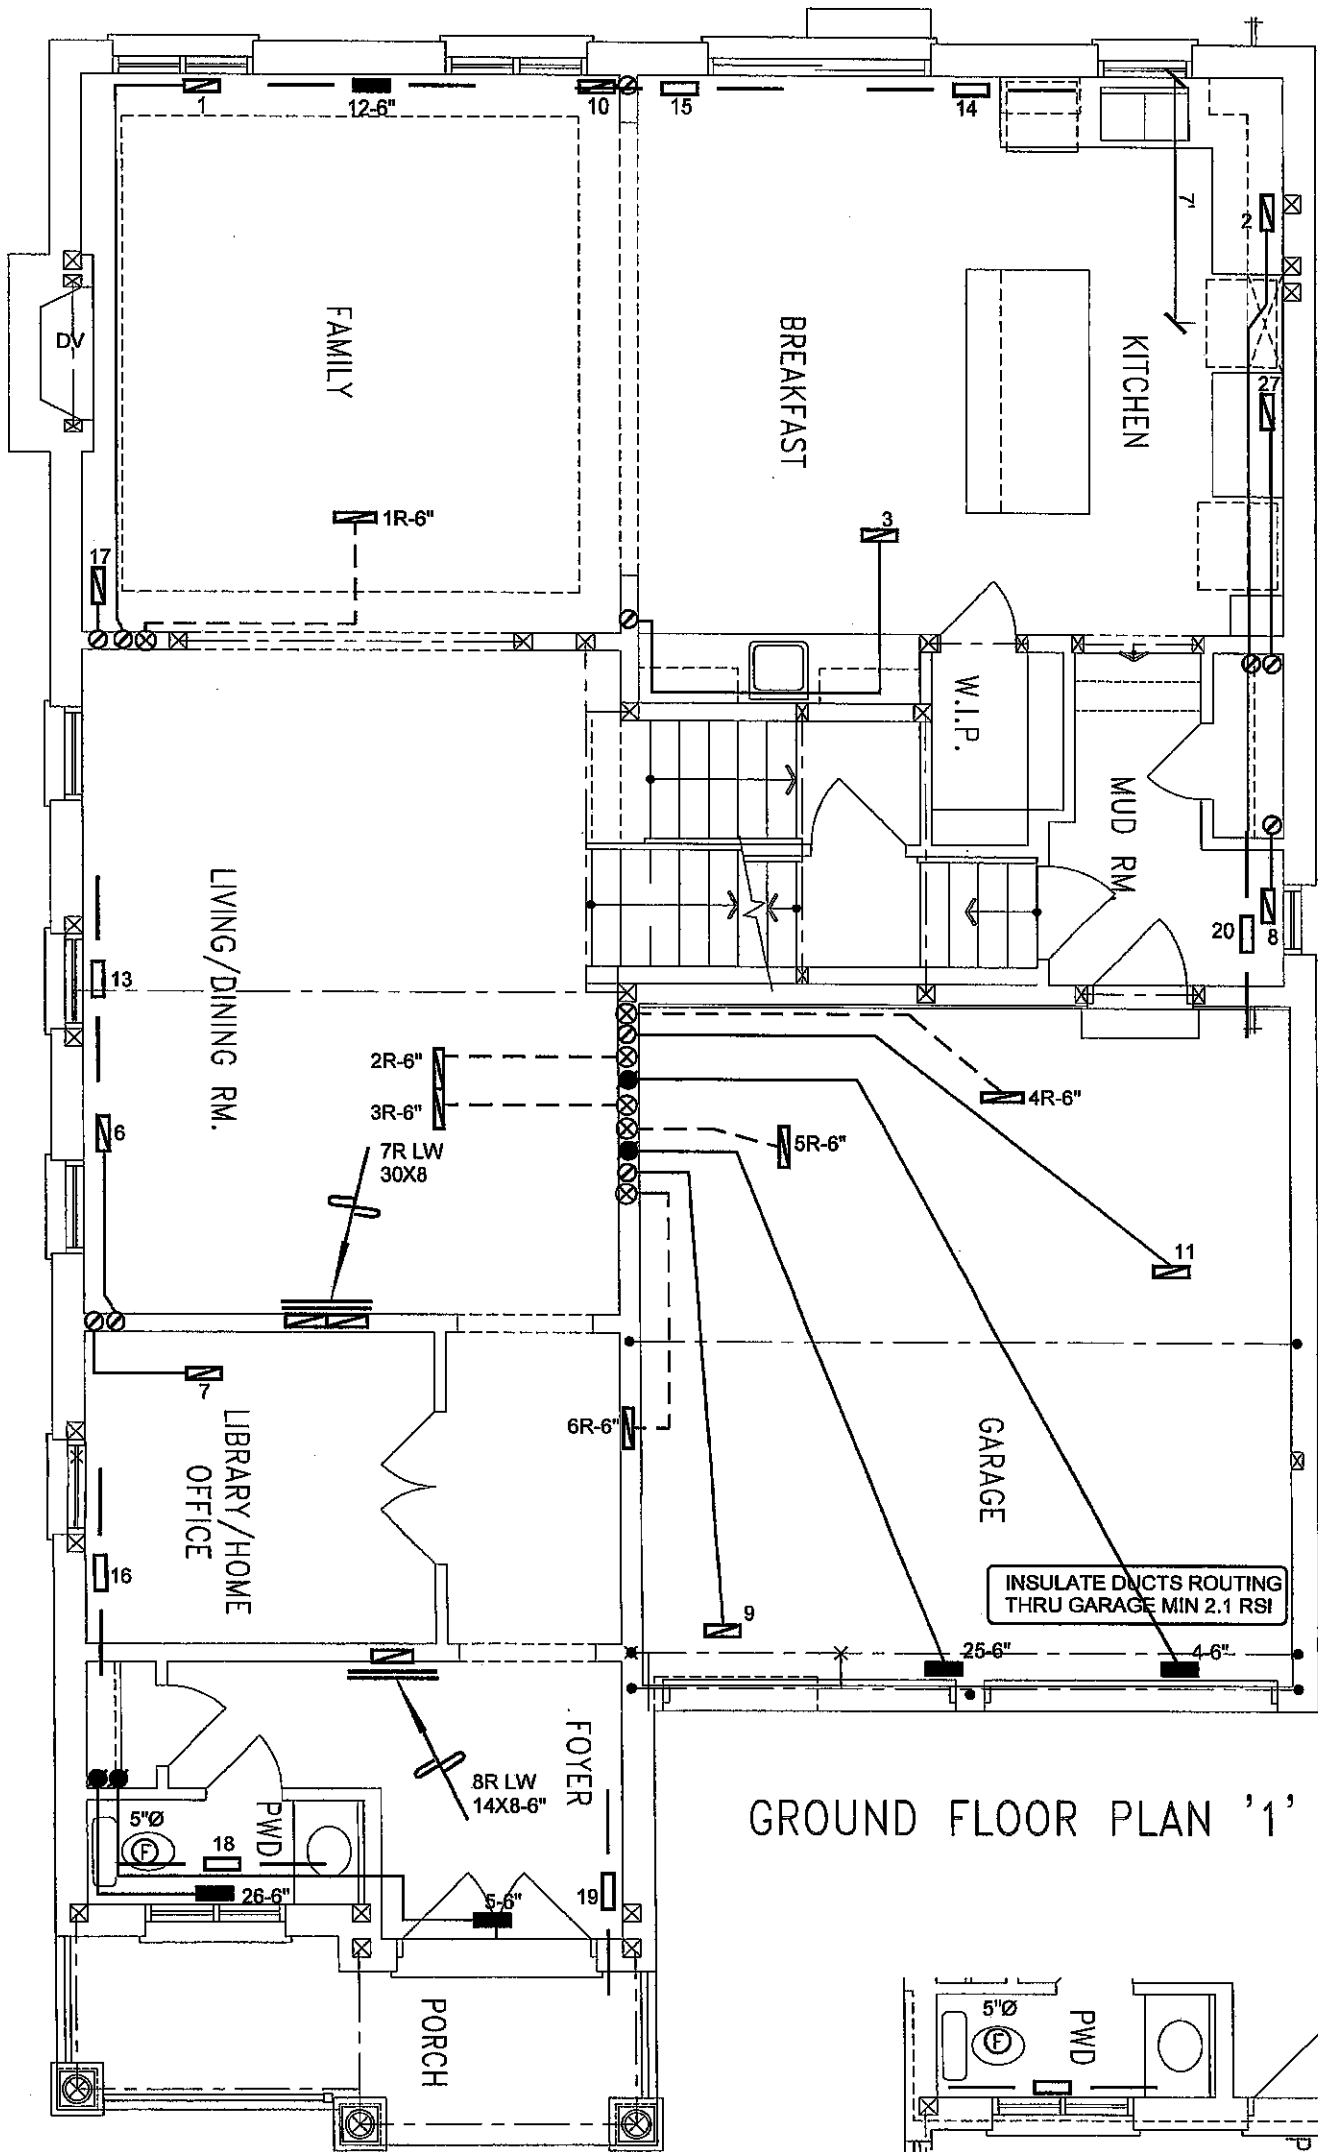

GROUND FLOOR PLAN '1'

GROUND FLOOR PLAN '3'

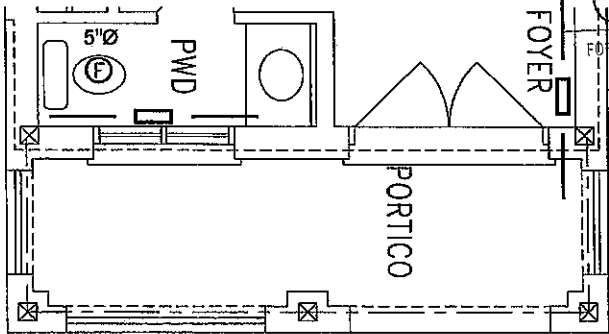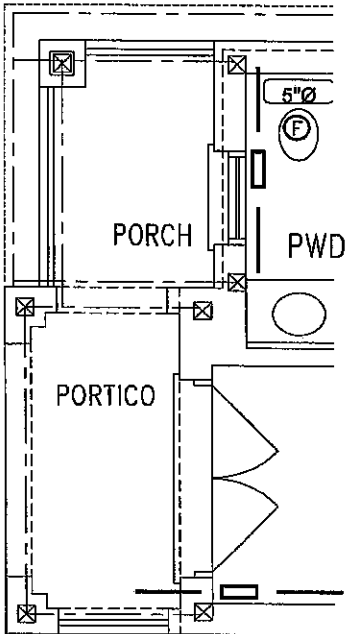

GROUND FLOOR PLAN '2'

CITY OF HAMILTON
Building Division

Permit No. 20-187748

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAWS

These drawings and/or specifications have been reviewed by
[Signature] DEC 14/20
FOR CHIEF BUILDING OFFICIAL DATE

I MICHAEL O'ROURKE HAVE REVIEWED
AND TAKE RESPONSIBILITY FOR THE
DESIGN WORK AND AM QUALIFIED
UNDER DIVISION C, 3.2.5 OF THE
BUILDING CODE.
Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

HVAC LEGEND

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER

3.		
2.		
1.		
No.	Description	Date
REVISIONS		



ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client
GREENPARK HOMES
Project Name
**RUSSEL GARDENS PHASE 3
HAMILTON, ONTARIO**
MOUNTAINASH 5 3298 sqft

HVAC DESIGNS LTD.
375 Finley Ave. Suite 202 - Ajax, Ontario
L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375
Email: info@hvacdesigns.ca
Web: www.hvacdesigns.ca
Specializing in Residential Mechanical Design Services
Installation to comply with the latest Ontario Building Code. All supply
branch outlets shall be equipped with a manual balancing damper.
Ductwork which passes through the garage or unheated spaces shall be
adequately insulated and be gas-proofed.

Sheet Title
**FIRST FLOOR
HEATING
LAYOUT**
Date **APRIL/2020**
Scale **3/16" = 1'-0"**
BCIN# 19669
LO# **85969**

CSA-F280-12
PACKAGE A1

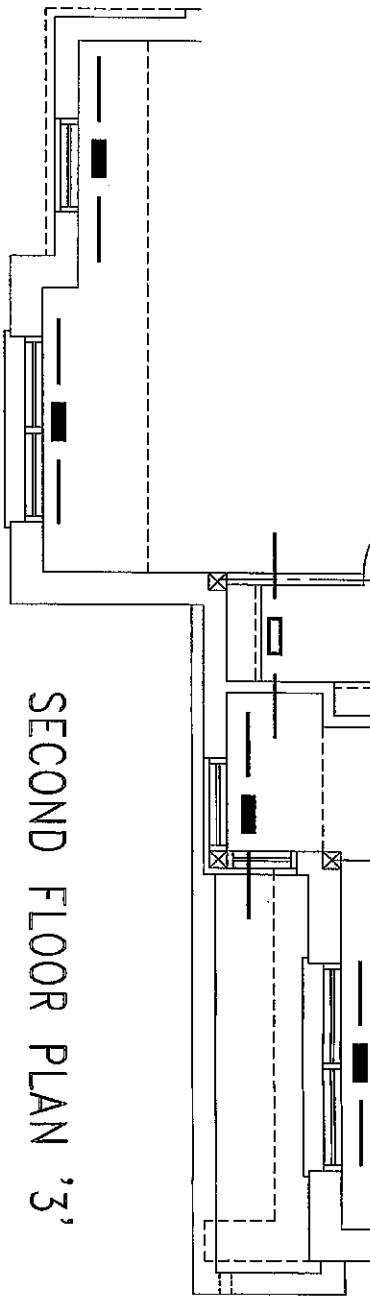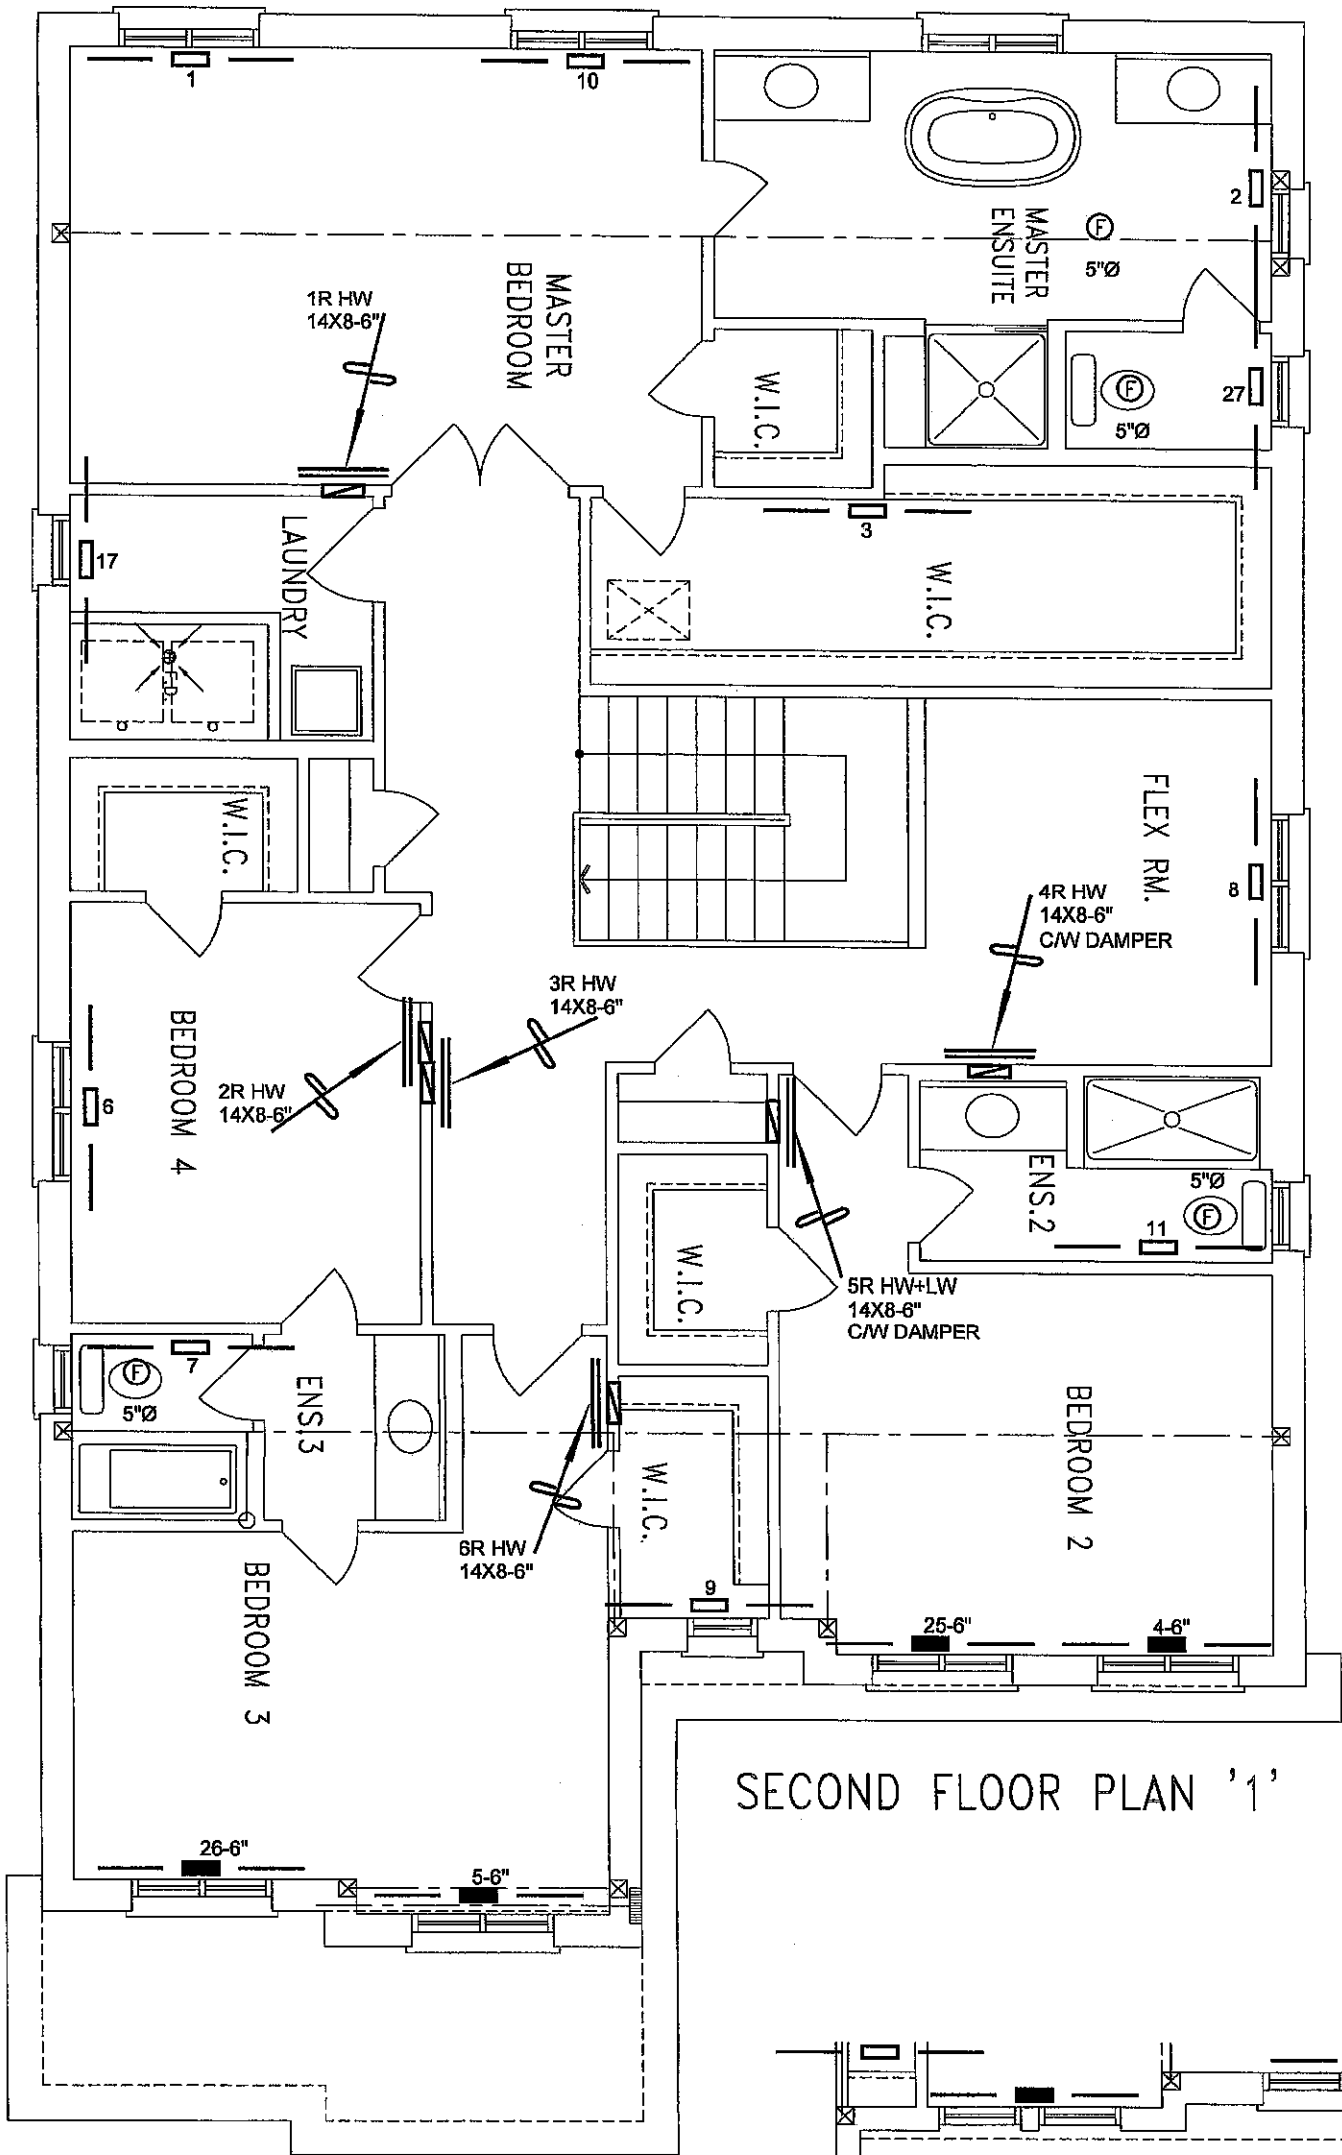

SECOND FLOOR PLAN '1'

CITY OF HAMILTON
Building Division

Permit No. **20-187748**

IF THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE LATEST MUNICIPAL BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by
[Signature] DATE **Dec 14/20**

BY BUILDING OFFICIAL

SECOND FLOOR PLAN '2'

CSA-F280-12
PACKAGE A1

I MICHAEL O'Rourke HAVE REVIEWED
AND TAKE RESPONSIBILITY FOR THE
DESIGN WORK AND AM QUALIFIED
UNDER DIVISION G, 32.5 OF THE
BUILDING CODE.
Michael O'Rourke
MICHAEL O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

HVAC LEGEND							3.		
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.	
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.	
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description
	SUPPLY AIR BOOT ABOVE		8" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER		Date

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client		HVACDESIGNS LTD. 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.	Sheet Title	
GREENPARK HOMES			SECOND FLOOR HEATING LAYOUT	
Project Name			Date	APRIL/2020
RUSSEL GARDENS PHASE 3 HAMILTON, ONTARIO			Scale	3/16" = 1'-0"
MOUNTAINASH 5 3298 sqft			BCIN# 19669	
		LO#	85969	