


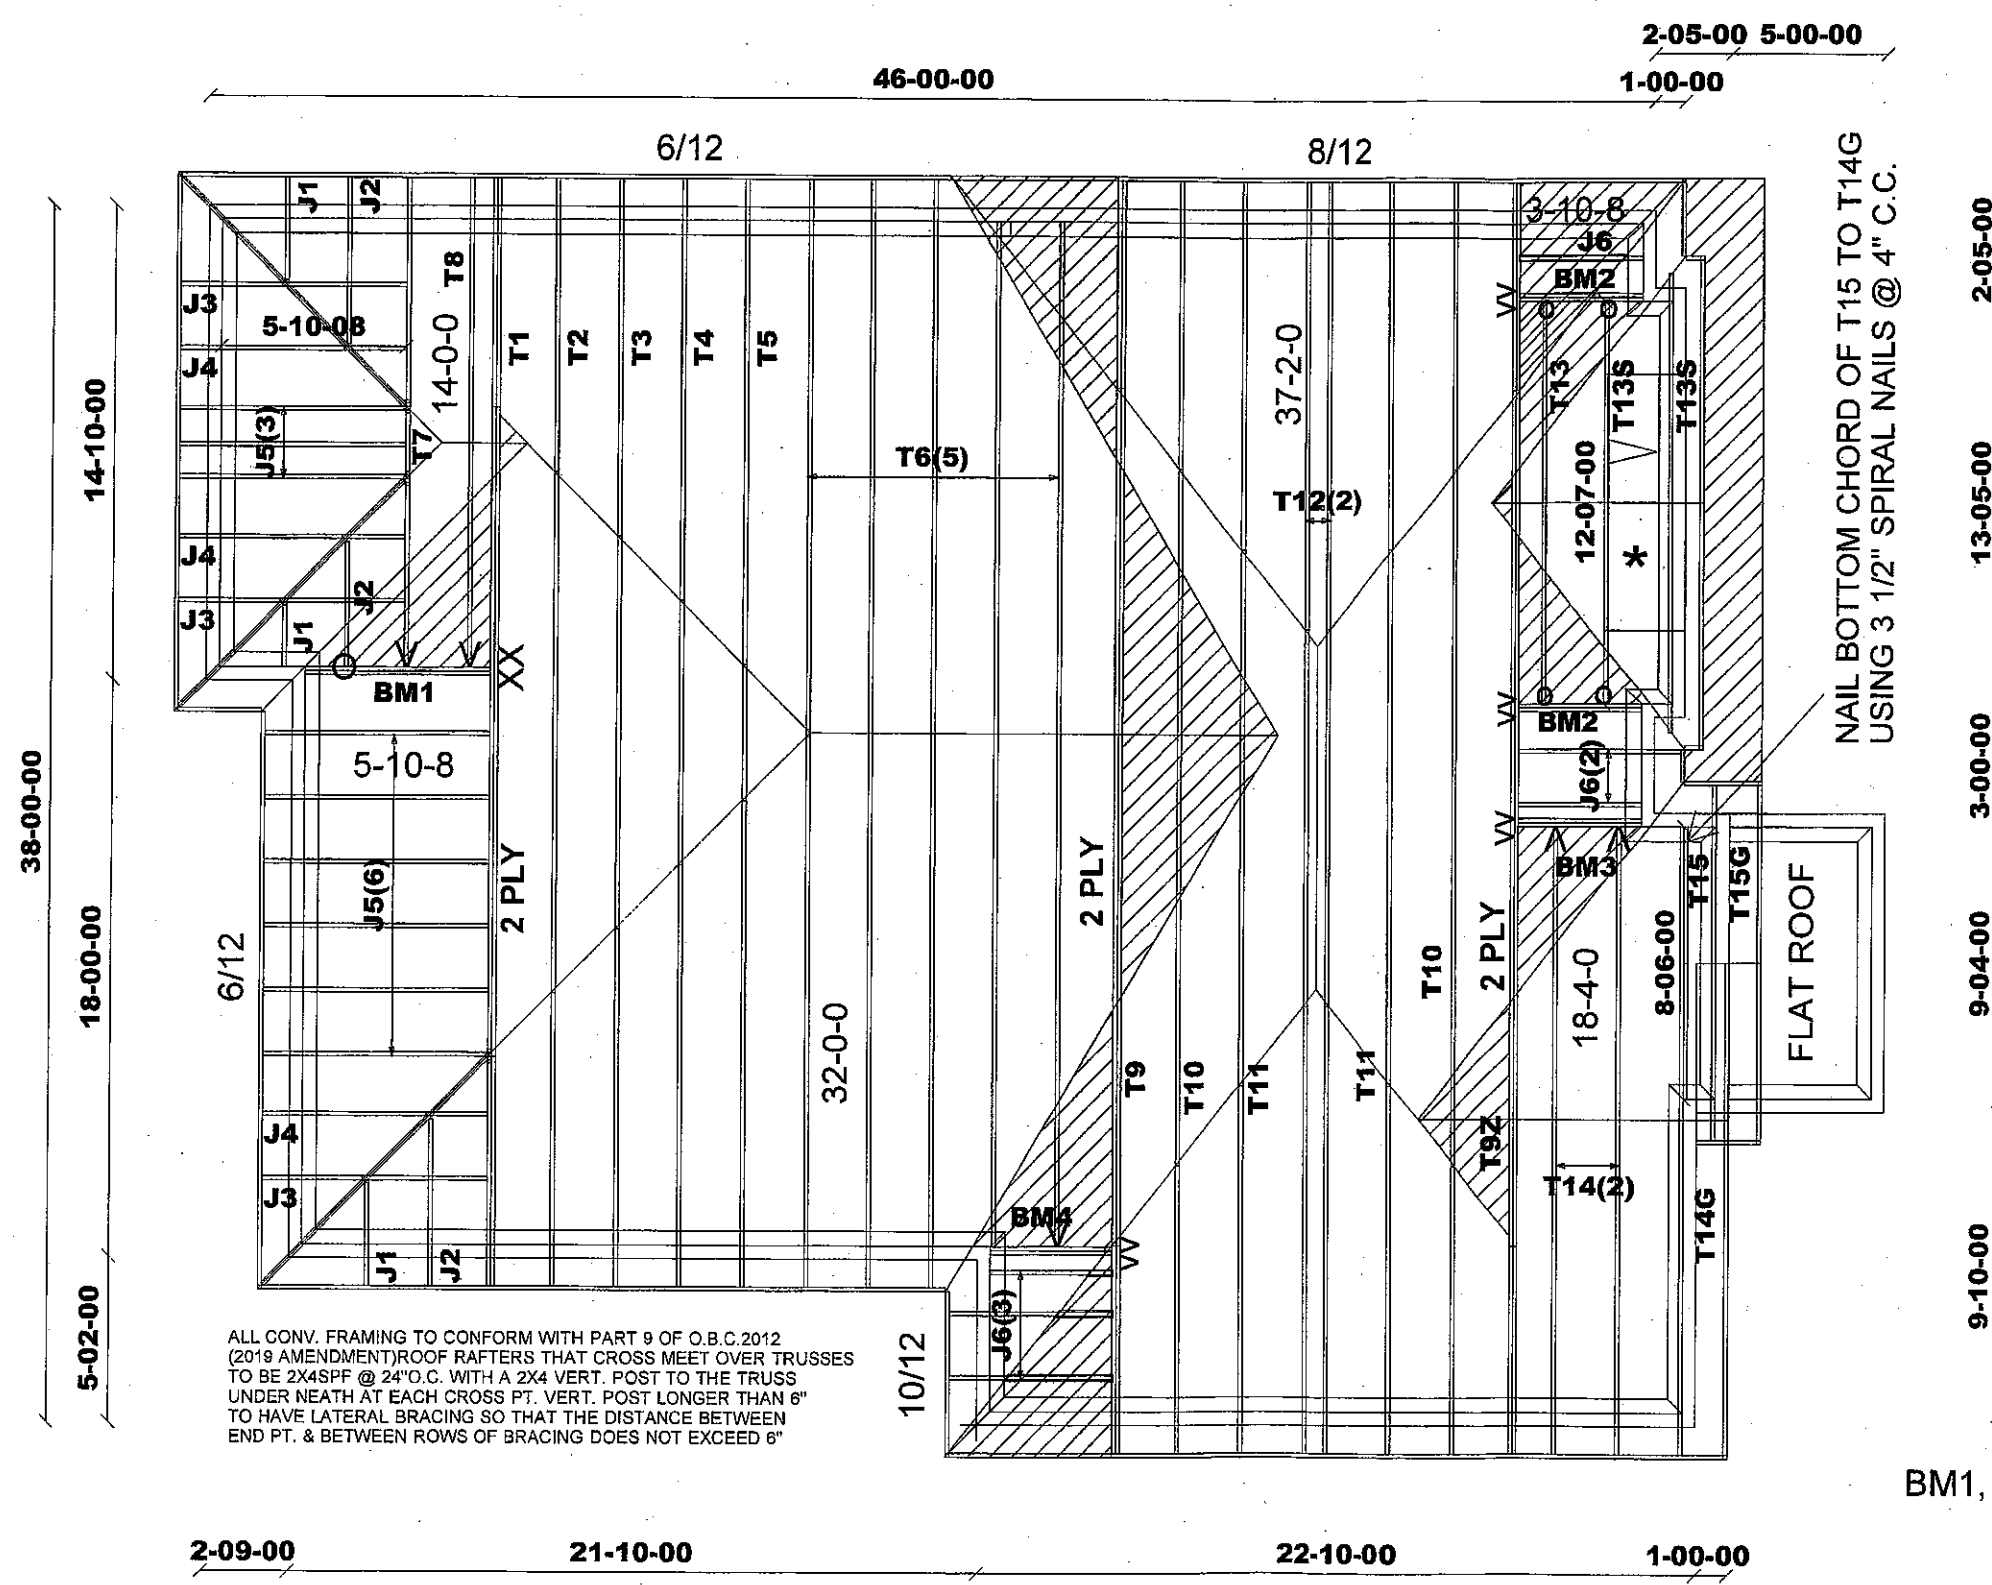

ASPHALT SHINGLES
12" FINISHED OH.
R.T.M.C.
2X6 EXTERIOR WALLS
2X6 FASCIA BOARD

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
LUS26-2 - (VV)

CONV. FRAMING

DESIGN CONFORMS
WITH O.B.C.2012 PART 9
(2019 AMENDMENT)
DESIGN LOADS:
SNOW LOAD 25.6 PSF
TC DEAD 6 PSF
BC LIVE 0 PSF
BC DEAD 7.4 PSF

* 16" RAISED CEILING

BM1, BM2, BM3, BM4 = 2-2X10

CITY OF HAMILTON
Building Division
Permit No. 20-187718
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
FOR CHIEF BUILDING OFFICIAL DATE

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department
NOV 15 2020
REC'D BY DATE
REF'D TO DATE

ALL CONV. FRAMING TO CONFORM WITH PART 9 OF O.B.C.2012
(2019 AMENDMENT) ROOF RAFTERS THAT CROSS MEET OVER TRUSSES
TO BE 2X4SPF @ 24" O.C. WITH A 2X4 VERT. POST TO THE TRUSS
UNDER NEATH AT EACH CROSS PT. VERT. POST LONGER THAN 6"
TO HAVE LATERAL BRACING SO THAT THE DISTANCE BETWEEN
END PT. & BETWEEN ROWS OF BRACING DOES NOT EXCEED 6"

 TAMARACK ROOF TRUSSES INC.	Job Track: 51225	Builder / Location: GREEN PARK HOMES / WATERDOWN	Model / Elevation: VALLEYCREEK 6/1	Mitek ver 8.3.1.215
	Plan Log: 202415			
	Layout ID: 408204	Project: RUSSELL GARDENS PH.3	THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.	
	Date: 2020-04-16	Sales: Mario DiCano	Designer: ACJ	

NOV 15 2020

REC'D BY: _____ DATE: _____

ASPHALT SHINGLES
12" FINISHED OH.
R.T.M.C.
2X6 EXTERIOR WALLS
2X6 FASCIA BOARD

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
LUS26-2 - (VV)

CITY OF HAMILTON
Building Division

Permit No. 20-187718


THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

Ken Smith Dec 17, 2020
FOR CHIEF BUILDING OFFICIAL DATE


DENOTES
CONV.
FRAMING




DESIGN CONFORMS
WITH O.B.C.2012 PART 9
(2019 AMENDMENT)
DESIGN LOADS:
SNOW LOAD 25.6 PSF
TC DEAD 6 PSF
BC LIVE 0 PSF
BC DEAD 7.4 PSF

* 16" RAISED CEILING

BM1=BM4=BM20 =
2-2X10

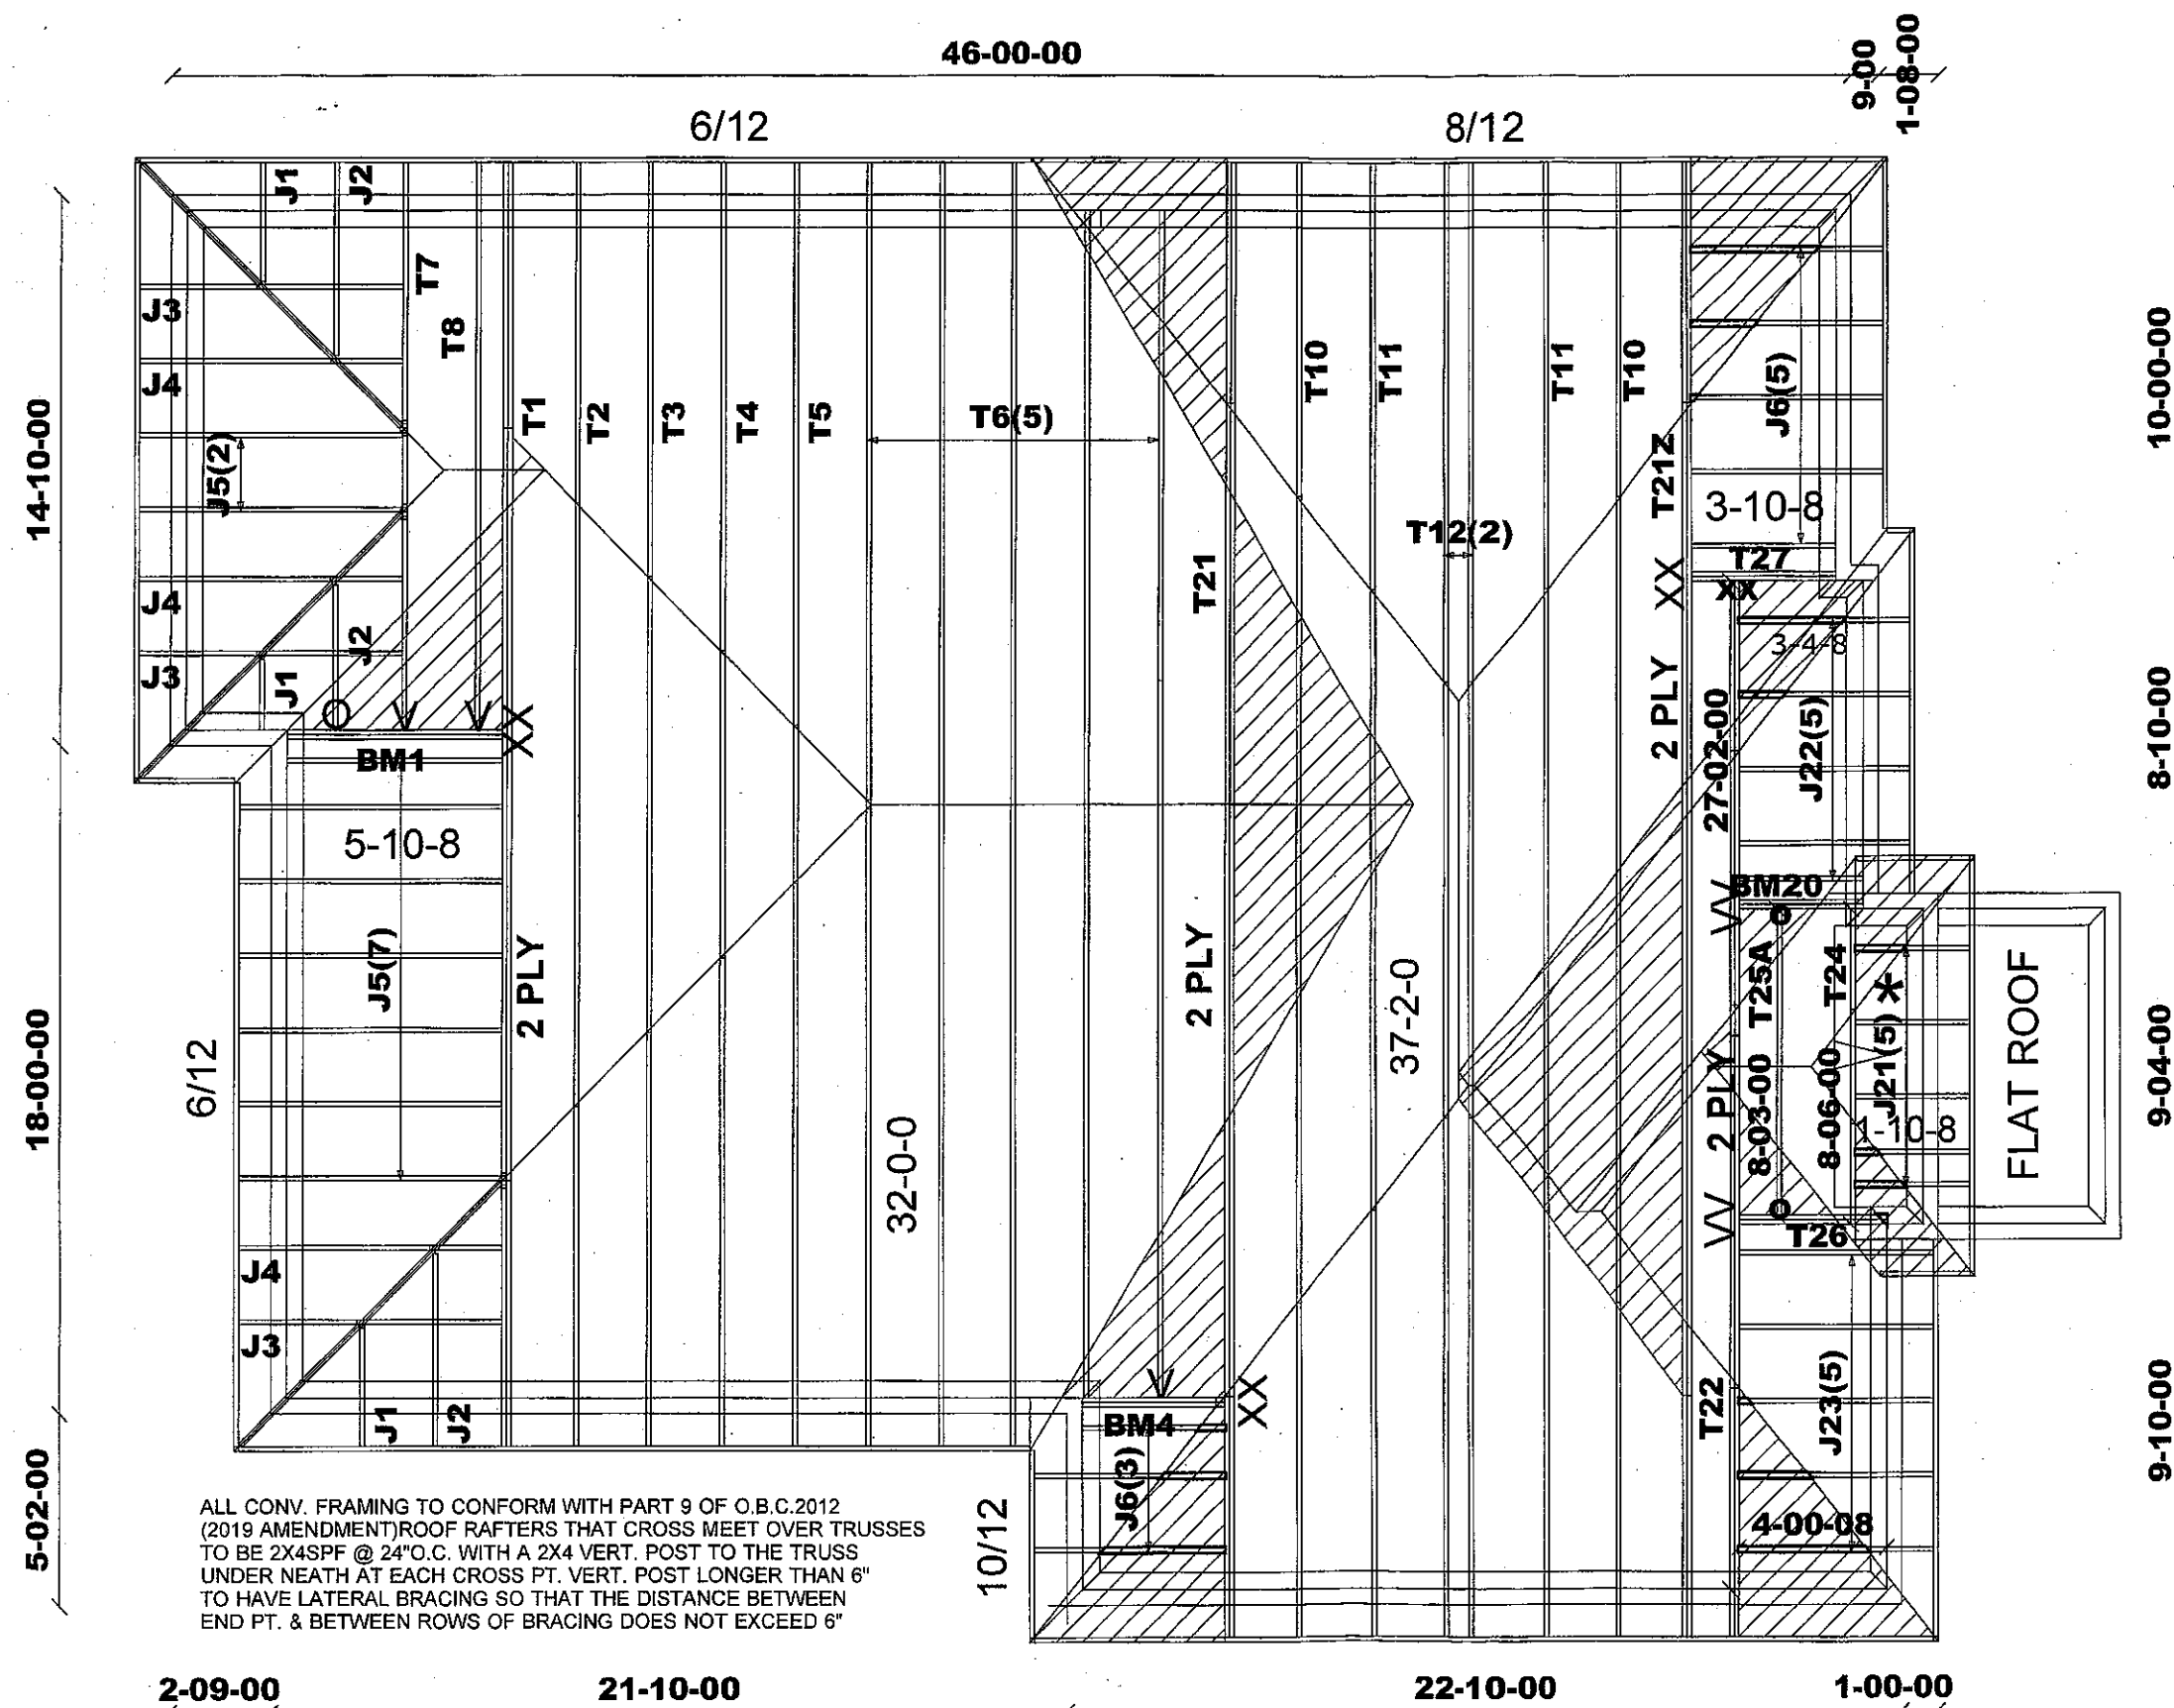

ALL CONV. FRAMING TO CONFORM WITH PART 9 OF O.B.C.2012
(2019 AMENDMENT) ROOF RAFTERS THAT CROSS MEET OVER TRUSSES
TO BE 2X4SPF @ 24"O.C. WITH A 2X4 VERT. POST TO THE TRUSS
UNDER NEATH AT EACH CROSS PT. VERT. POST LONGER THAN 6"
TO HAVE LATERAL BRACING SO THAT THE DISTANCE BETWEEN
END PT. & BETWEEN ROWS OF BRACING DOES NOT EXCEED 6"



Job Track: 51225
Plan Log: 202415
Layout ID: 408205

Builder / Location:
GREEN PARK HOMES / WATERDOWN
Project: RUSSELL GARDENS PH.3
Date: 2020-04-16 Sales: Mario DiCano Designer: AC/IG

Model / Elevation:
VALLEYCREEK 6/2

Mitek ver 8.3.1.215

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR
REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY
TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

NOV 15 2020

REC'D BY _____ DATE _____
REF'D TO _____ DATE _____

ASPHALT SHINGLES
12" FINISHED OH.
R.T.M.C.
2X6 EXTERIOR WALLS
2X6 FASCIA BOARD

CITY OF HAMILTON
Building Division

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)


Permit No. 20-187718

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

Ken Smith Dec 17, 2020
FOR CHIEF BUILDING OFFICIAL DATE


DENOTES
CONV.
FRAMING



DESIGN CONFORMS
WITH O.B.C.2012 PART 9
(2019 AMENDMENT)
DESIGN LOADS:
SNOW LOAD 25.6 PSF
TC DEAD 6 PSF
BC LIVE 0 PSF
BC DEAD 7.4 PSF

* 16" RAISED CEILING

BM1, BM2, BM3 = 2-2X10

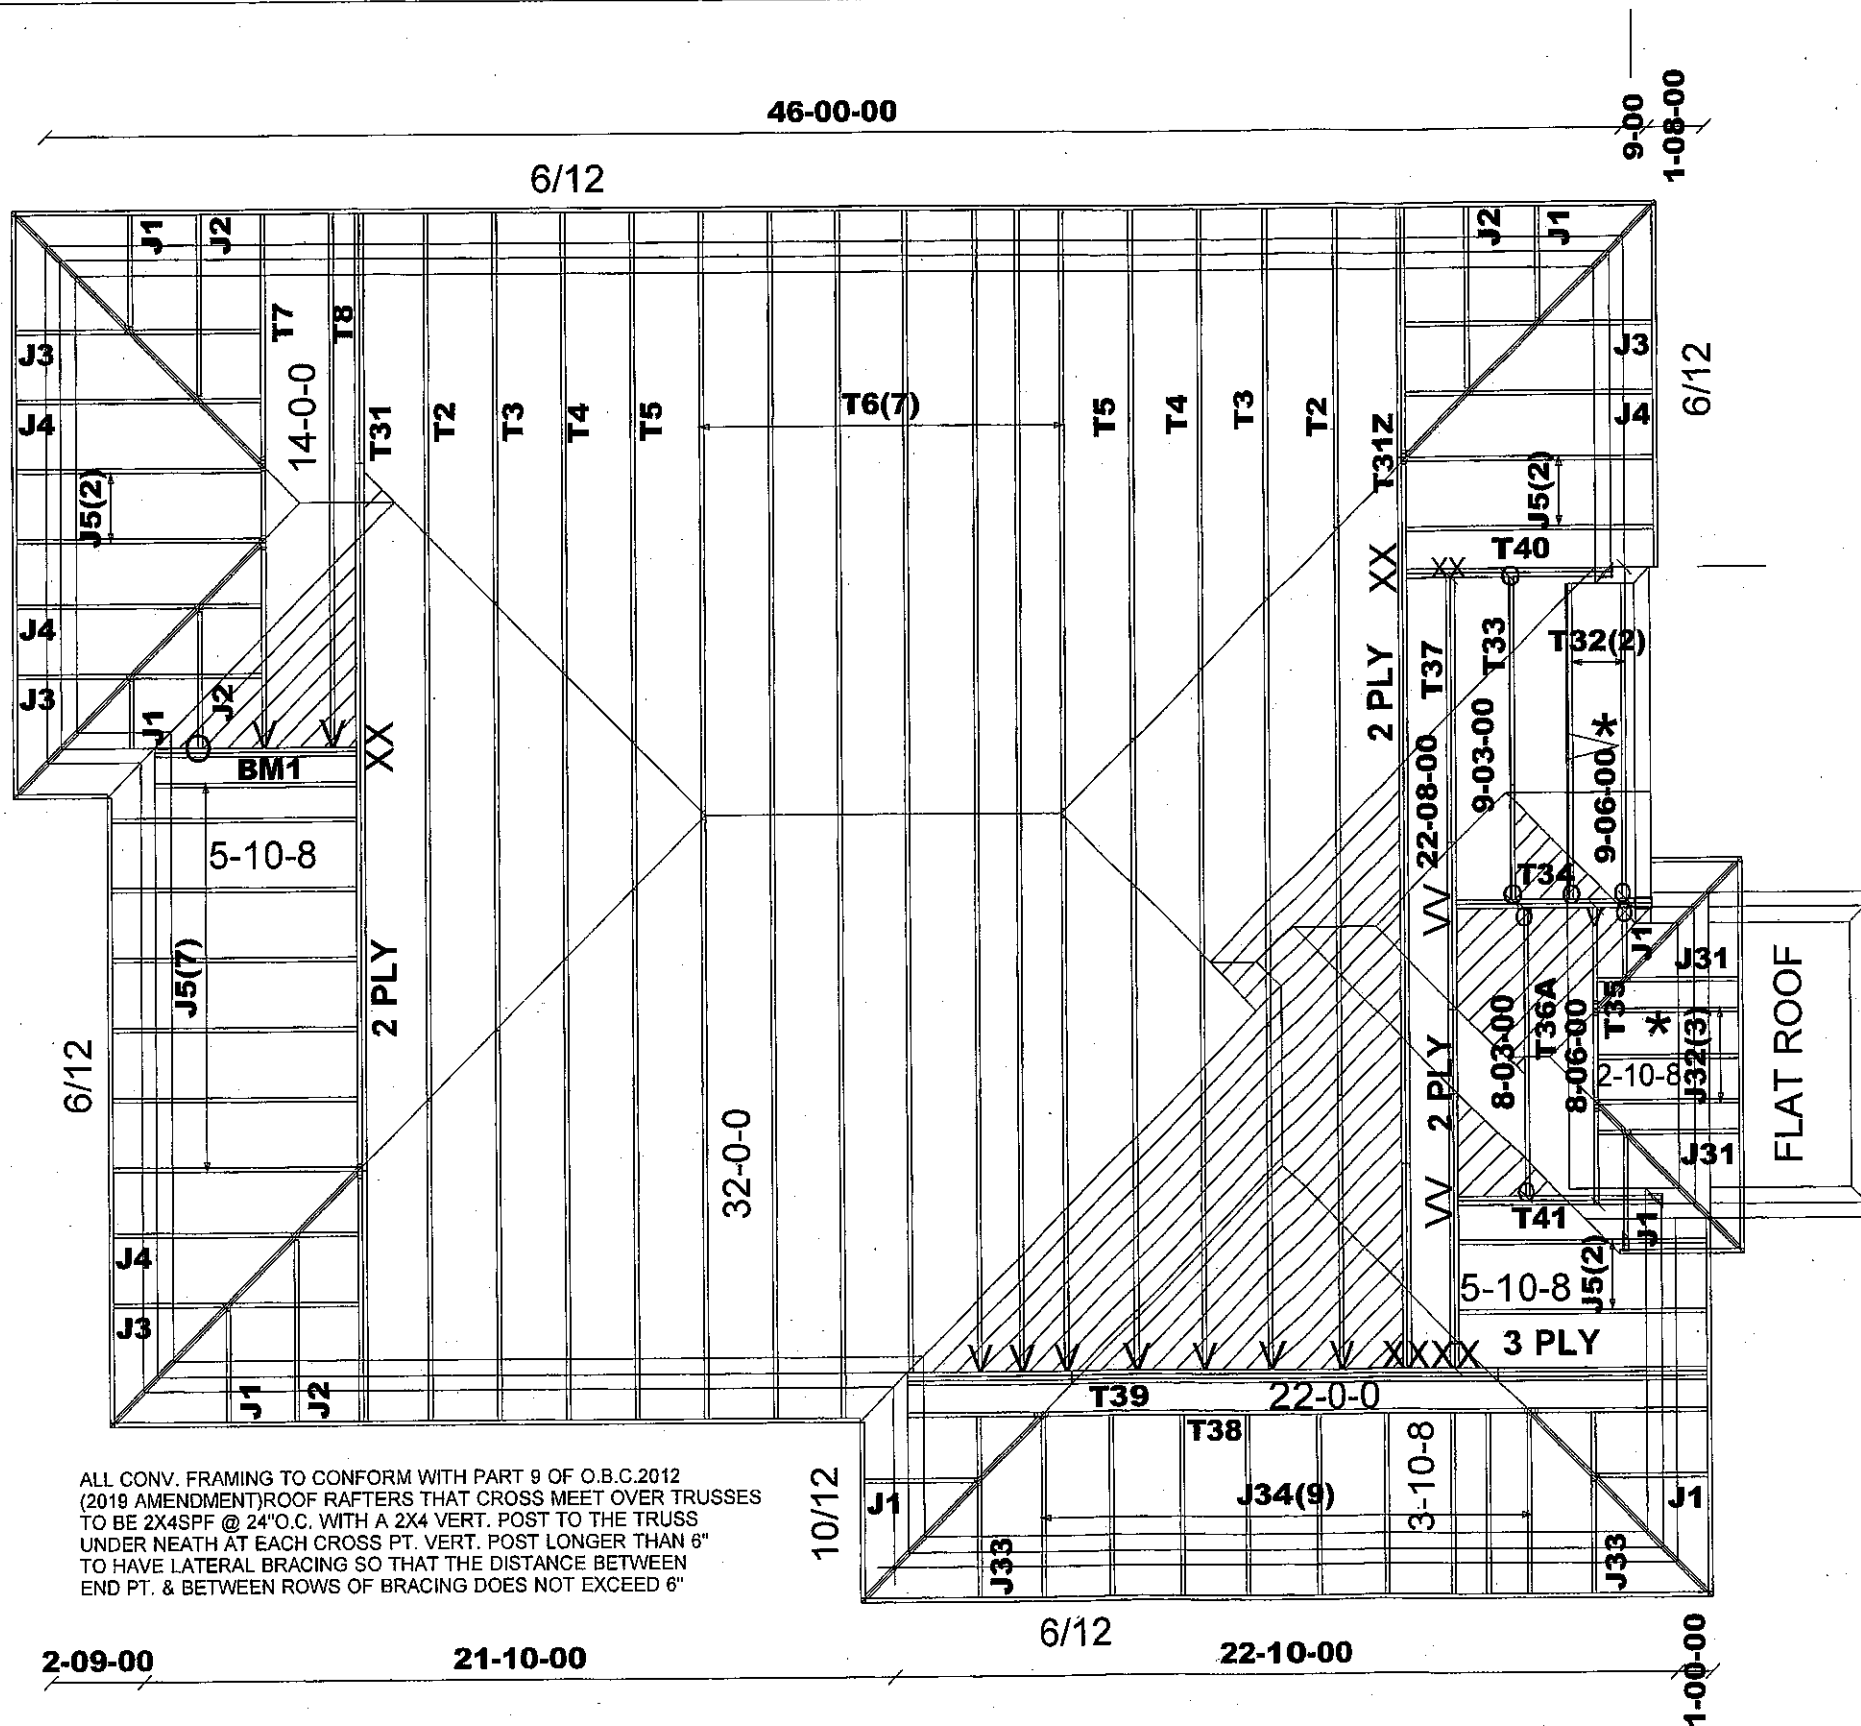

M13112



Job Track: 51225
Plan Log: 202415
Layout ID: 408206

Builder / Location:
GREEN PARK HOMES / WATERDOWN
Project: **RUSSELL GARDENS PH.3**
Date: 2020-04-16 Sales: Mario DiCano Designer: AC/JG

Model / Elevation:
VALLEYCREEK 6/3

Mitek ver 8.3.1.215

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: VALLEYCREEK 6
 Lot #:
 Elevation: 1

Job Track: 51225
 PlanLog: 202415
 Layout ID: 408204
 Ref #
 Page: 1 of 2
 Date: 04-16-2020
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	6 /12	32-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	288.29 184.00		
	1	T2 Hip	6 /12	32-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	129.76 81.50		
	1	T3 Hip	6 /12	32-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	129.36 82.33		
	1	T4 Hip	6 /12	32-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	135.83 84.83		
	1	T5 Hip	6 /12	32-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	131.5 83.17		
	5	T6 Hip	6 /12	32-00-00	9-02-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	647.77 407.50		
	1	T7 Hip Girder	6 /12	14-00-00	4-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	59.02 38.67		
	1	T8 Common	6 /12	14-00-00	4-08-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	55.49 35.50		
	1 2-ply	T9 Hip Girder	8 /12	37-02-00	4-10-07	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	351.67 215.33		
	1 2-ply	T9Z Hip Girder	8 /12	37-02-00	4-10-07	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	351.67 215.33		
	2	T10 Hip	8 /12	37-02-00	6-06-07	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	327.85 202.00		
	2	T11 Hip	8 /12	37-02-00	8-02-07	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	337.47 212.00		
	2	T12 Hip	8 /12	37-02-00	9-10-07	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	351.09 220.87		
	1	T13 Common	8 /12	12-07-00	5-07-02	2 x 4		1-04-13 1-04-13	51.65 33.17		







CITY OF HAMILTON
 BUILDING DIVISION
 Planning & Development Department

NOV 15 2020

REC'D BY _____ DATE _____
 8317'D TO _____ DATE _____

 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP		DELIVERY SHIPLIST	
Lumber Yard:	TAMARACK LUMBER	Job Track:	51225
Builder:	GREEN PARK HOMES	PlanLog:	202415
Project:	RUSSELL GARDENS PH.3	Layout ID:	408204
Location:	WATERDOWN	Ref #	
Model:	VALLEYCREEK 6	Page:	2 of 2
Lot #:		Date:	04-16-2020
Elevation:	1	Designer:	Andrew Conway
		Sales Rep:	Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T13S Roof Special	8 / 12	12-07-00	5-07-02	2 x 4		1-04-13 1-04-13	113.8 76.67		
	2	T14 Common	8 / 12	18-04-00	7-06-02	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	161.18 100.67		
	1	T14G GABLE	8 / 12	18-04-00	7-06-02	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	83.28 52.83		
	1	T15 Common	8 / 12	8-06-00	4-02-13	2 x 4		1-04-13 1-04-13	33.35 21.83		
	1	T15G GABLE	8 / 12	8-06-00	4-02-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	37.61 24.67		
	3	J1 Jack-Open	6 / 12	2-00-00	2-01-08	2 x 4	1-03-08	1-02-00 2-02-00	21.97 14.00		
	3	J2 Jack-Open	6 / 12	2-00-00	3-01-08	2 x 4	1-03-08 1-10-15	1-02-00 2-02-00	29.62 18.00		
	3	J3 Jack-Open	6 / 12	1-10-15	2-01-08	2 x 4	1-03-08 3-11-09	1-02-00 2-01-08	35.22 22.00		
	3	J4 Jack-Open	6 / 12	3-10-15	3-01-08	2 x 4	1-03-08 1-11-09	1-02-00 3-01-08	42.87 26.00		
	9	J5 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	151.15 96.00		
	6	J6 Jack-Open	10 / 12	3-10-08	4-10-07	2 x 4	1-03-08	1-07-11 4-10-07	93.44 61.00		

TOTAL # TRUSS= 58

TOTAL BFT OF ALL TRUSSES= 2609.17

BFT.

TOTAL WEIGHT OF ALL TRSSES 4151.89 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
5	Hardware	LJS26DS	
5	Hardware	LUS24	
4	Hardware	LUS26-2	
1	Hardware	HGUS26-2	

TOTAL NUMBER OF
ITEMS=

15



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: VALLEYCREEK 6
 Lot #:
 Elevation: 2

Job Track: 51225
 PlanLog: 202415
 Layout ID: 408205
 Ref #
 Page: 1 of 3
 Date: 04-16-2020
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	6/12	32-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	302.58 196.00		
	1	T2 Hip	6/12	32-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	129.76 81.50		
	1	T3 Hip	6/12	32-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	129.36 82.33		
	1	T4 Hip	6/12	32-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	135.83 84.83		
	1	T5 Hip	6/12	32-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	131.5 83.17		
	5	T6 Hip	6/12	32-00-00	9-02-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	647.77 407.50		
	1	T7 Hip Girder	6/12	14-00-00	4-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	59.02 38.67		
	1	T8 Common	6/12	13-11-08	4-08-00	2 x 4	1-03-12 1-03-12	1-02-02 1-02-02	55.51 36.50		
	2	T10 Hip	8/12	37-02-00	6-06-07	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	374.81 226.87		
	2	T11 Hip	8/12	37-02-00	8-02-07	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	384.77 238.67		
	2	T12 Hip	8/12	37-02-00	9-10-07	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	398.69 241.33		
	1 2-ply	T21 Hip Girder	8/12	37-02-00	4-10-07	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	351.56 213.33		
	1 2-ply	T21Z Hip Girder	8/12	37-02-00	4-10-07	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	351.56 213.33		
	1 2-ply	T22 Roof Special Girder	8/12	27-02-00	5-00-02	2 x 4 2 x 6	1-03-08	1-04-13 1-04-13	265.79 167.33		

CITY OF HAMILTON
 BUILDING DIVISION
 Planning & Development Department
 NOV 15 2020

RECEIVED BY _____ DATE _____
 APPROVED BY _____ DATE _____



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: VALLEYCREEK 6
 Lot #:
 Elevation: 2

Job Track: 51225
 PlanLog: 202415
 Layout ID: 408205
 Ref #
 Page: 2 of 3
 Date: 04-16-2020
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T24 Hip Girder	8/12	8-06-00	3-02-07	2 x 4		1-04-13 1-04-13	34.79 23.33		
	1	T25A Common	8/12	8-03-00	5-06-13	2 x 4		2-08-13 2-10-13	37.78 24.83		
	1 2-ply	T26 Monopitch Girder	0/12	4-00-08	1-04-00	2 x 4		1-04-00 1-04-00	27.61 20.00		
	1 2-ply	T27 Monopitch Girder	10/12	3-10-08	4-10-07	2 x 4 2 x 6		1-07-11 4-10-07	48.07 32.33		
	3	J1 Jack-Open	6/12	2-00-00	2-01-08	2 x 4	1-03-08	1-02-00 2-02-00	21.97 14.00		
	3	J2 Jack-Open	6/12	2-00-00	3-01-08	2 x 4	1-03-08 1-10-15	1-02-00 2-02-00	29.62 18.00		
	3	J3 Jack-Open	6/12	1-10-15	2-01-08	2 x 4	1-03-08 3-11-09	1-02-00 2-01-08	35.22 22.00		
	3	J4 Jack-Open	6/12	3-10-15	3-01-08	2 x 4	1-03-08 1-11-09	1-02-00 3-01-08	42.87 26.00		
	9	J5 Jack-Open	6/12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	151.15 98.00		
	8	J6 Jack-Open	10/12	3-10-08	4-10-07	2 x 4	1-03-08	1-07-11 4-10-07	124.58 81.33		
	5	J21 Jack-Open	10/12	1-10-08	3-02-07	2 x 4	1-03-08	1-07-11 3-02-07	50.61 35.00		
	5	J22 Jack-Open	10/12	3-04-08	4-05-07	2 x 4	1-03-08	1-07-11 4-05-07	71.3 50.83		
	5	J23 Jack-Open	10/12	4-00-08	5-00-02	2 x 4	1-03-08	1-07-11 5-00-02	80.05 57.50		

TOTAL # TRUSS= 75

TOTAL BFT OF ALL TRUSSES= 2812.31

BFT. TOTAL WEIGHT OF ALL TRSSES 4474.15 LBS

CITY OF HAMILTON
 BUILDING DEPARTMENT
 Planning & Development Department
 NOV 15 2020

DELIVERY SHIPLIST		
 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: VALLEYCREEK 6 Lot #: Elevation: 2	Job Track: 51225 PlanLog: 202415 Layout ID: 408205 Ref # Page: 3 of 3 Date: 04-16-2020 Designer: Andrew Conway Sales Rep: Mario DiCano

HARDWARE



QTY	TYPE	MODEL	LENGTH
3	Hardware	LJS26DS	
3	Hardware	LUS24	
2	Hardware	LUS26-2	
4	Hardware	HGUS26-2	

TOTAL NUMBER OF
ITEMS= 12

CITY OF HAMILTON BUILDING DIVISION Planning & Development & Enforcement	
NOV 15 2020	
REC'D BY _____	DATE _____
REF'D TO _____	DATE _____




 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	DELIVERY SHIPLIST				Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: VALLEYCREEK 6 Lot #: Elevation: 3		Job Track: 51225 PlanLog: 202415 Layout ID: 408206 Ref # Page: 1 of 3 Date: 04-16-2020 Designer: Andrew Conway Sales Rep: Mario DiCano	
--	--------------------------	--	--	--	---	--	---	--

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T2 Hip	6 / 12	32-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	259.51 183.00		
	2	T3 Hip	6 / 12	32-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	258.73 184.67	CITY OF HAMILTON BUILDING DIVISION Planning & Development Department NOV 15 2020 RECEIVED DATE	
	2	T4 Hip	6 / 12	32-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	271.66 189.67		
	2	T5 Hip	6 / 12	32-00-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	263.01 166.33		
	7	T6 Hip	6 / 12	32-00-00	9-02-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	906.87 570.50		
	1	T7 Hip Girder	6 / 12	14-00-00	4-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	59.02 38.67		
	1	T8 Common	6 / 12	13-11-08	4-08-00	2 x 4	1-03-12 1-03-12	1-02-02 1-02-02	55.51 36.50		
	1 2-ply	T31 Hip Girder	6 / 12	32-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	299.02 190.00		
	1 2-ply	T31Z Hip Girder	6 / 12	32-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	299.02 190.00		
	2	T32 Common	6 / 12	9-00-08	3-03-06	2 x 4		3-08 1-09-00	57.12 36.67		
	1	T33 Half Hip	6 / 12	9-03-00	4-06-00	2 x 4		1-06-04 4-06-00	39.53 25.50		
	1 2-ply	T34 Monopitch Girder	6 / 12	5-07-08	5-03-12	2 x 4 2 x 6		1-02-00 5-03-12	73.85 49.67		
	1	T35 Hip Girder	6 / 12	8-06-00	2-07-04	2 x 4		1-02-00 1-02-00	32.24 22.67		
	1	T36A Common	6 / 12	8-03-00	4-07-08	2 x 4		2-06-00 2-07-08	35.26 24.17		

 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST				Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: VALLEYCREEK 6 Lot #: Elevation: 3		Job Track: 51225 PlanLog: 202415 Layout ID: 408206 Ref # Page: 2 of 3 Date: 04-16-2020 Designer: Andrew Conway Sales Rep: Mario DiCano	
---	--------------------------	--	--	--	---	--	---	--

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T37 Roof Special Girder	6 /12	22-08-00	5-03-12	2 x 4 2 x 6		1-06-04 3-09-00	227.31 143.33		
	1	T38 Hip Girder	6 /12	22-00-00	3-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	83.13 53.67		
	1 3-ply	T39 Hip Girder	6 /12	22-00-00	3-06-12	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	330.32 210.50		
	1 2-ply	T40 Monopitch Girder	0 /12	5-10-08	1-04-00	2 x 6		1-04-00 1-04-00	53.05 33.67		
	1 2-ply	T41 Monopitch Girder	0 /12	5-10-08	1-04-00	2 x 4		1-04-00 1-04-00	40.05 25.67		
	8	J1 Jack-Open	6 /12	2-00-00	2-01-08	2 x 4	1-03-08	1-02-00 2-02-00	58.58 37.33		
	4	J2 Jack-Open	6 /12	2-00-00	3-01-08	2 x 4	1-03-08 1-10-15	1-02-00 2-02-00	39.49 24.00		
	4	J3 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 3-11-09	1-02-00 2-01-08	46.97 29.33		
	4	J4 Jack-Open	6 /12	3-10-15	3-01-08	2 x 4	1-03-08 1-11-09	1-02-00 3-01-08	57.17 34.67		
	13	J5 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	218.33 138.67		
	2	J31 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 11-09	1-02-00 2-01-08	16.64 10.67		
	3	J32 Jack-Open	6 /12	2-10-08	2-07-04	2 x 4	1-03-08	1-02-00 2-07-04	28.65 18.00		
	2	J33 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 1-11-09	1-02-00 2-01-08	18.92 12.00		
	9	J34 Jack-Open	6 /12	3-10-08	3-01-04	2 x 4	1-03-08	1-02-00 3-01-04	107.68 66.00		

TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP		DELIVERY SHIPLIST	
Lumber Yard:	TAMARACK LUMBER	Job Track:	51225
Builder:	GREEN PARK HOMES	PlanLog:	202415
Project:	RUSSELL GARDENS PH.3	Layout ID:	408206
Location:	WATERDOWN	Ref #	
Model:	VALLEYCREEK 6	Page:	3 of 3
Lot #:		Date:	04-16-2020
Elevation:	3	Designer:	Andrew Conway
		Sales Rep:	Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
---------	------------	--------------	-------	------	--------	--------	---------------------------	------------------------------	--------------	---------------------	--------------------

TOTAL # TRUSS= 87 TOTAL BFT OF ALL TRUSSES= 2685.53 BFT. TOTAL WEIGHT OF ALL TRSSES 4236.62 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
11	Hardware	LJS26DS	
9	Hardware	LUS24	
5	Hardware	HGUS26-2	

TOTAL NUMBER OF
ITEMS= 25

CITY OF HAMILTON BUILDING DIVISION Planning & Development Department	
NOV 15 2020	
REC'D BY _____	DATE _____
REC'D TO _____	DATE _____

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408204	T1	1	2	TRUSS DESC.		

Tamarack Road Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 07:47:44 2020 Page 2
ID:9ZM6hL/4ow3EYqKIUWHCzIHzo-mT2C9IvoBPXZzSndiVIsXo8ztGoePF4TCEBnzPuOT

PLATES (table is in inches)


JT TYPE	PLATES	W	LEN	Y	X
T	BMV1+p	MT20	3.0	6.0	

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
Y	24-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Z	27-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AA	29-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER MECHANICAL CONNECTION IS REQUIRED.

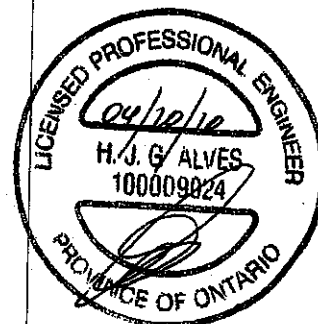


Structural component only
DWG# T-2006376

2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408204	T2	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington	Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 07:47:45 2020 Page 1
1-3-8 0-0 4-0-8 4-0-8 3-10-0 7-10-8 5-5-7 13-3-15 5-4-3 18-9-1 5-5-7 24-1-8 3-10-0 27-11-8 4-0-8 1-3-8	ID:9ZM6hL4ow3EYgKtUWHCzIH2o-EfcaNevQy?OA711V?DkP43z5NEuX7IPJ7yvjDzPuOS
1-3-8 0-0 4-0-8 4-0-8 3-10-0 7-10-8 5-5-7 13-3-15 5-4-3 18-9-1 5-5-7 24-1-8 3-10-0 27-11-8 4-0-8 1-3-8	Scale = 1:52.8

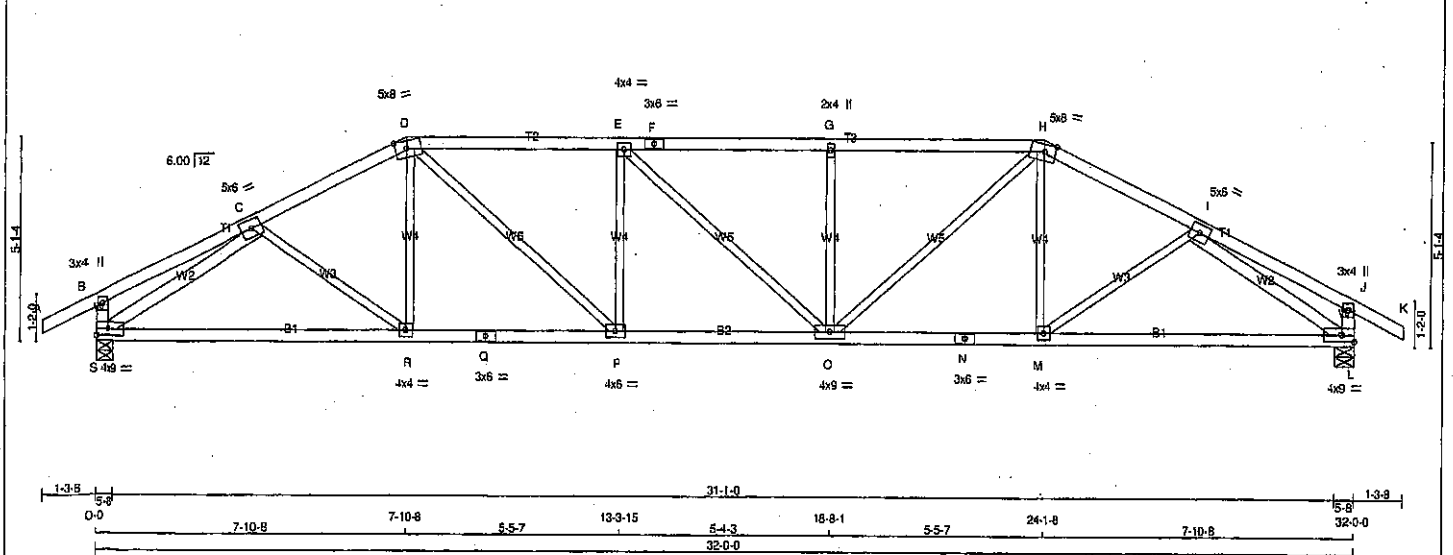


LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.	BEARINGS				SPECIFIED LOADS:			
A - D	2x4	DRY	No.2	FACTORED	MAXIMUM FACTORED	INPUT	REQD	TOP CH. LL = 25.6 PSF			
D - F	2x4	DRY	No.2	GROSS REACTION	GROSS REACTION	BRG	BRG	DL = 6.0 PSF			
F - H	2x4	DRY	No.2	JT VERT	DOWN	UPLIFT	IN-SX	BOT CH. LL = 0.0 PSF			
H - K	2x4	DRY	No.2	S	1889	0	0	DL = 7.4 PSF			
S - B	2x4	DRY	No.2	L	1889	0	0	TOTAL LOAD = 39.0 PSF			
L - J	2x4	DRY	No.2	UNFACTORED REACTIONS				SPACING = 24.0 IN. C/C			
S - Q	2x4	DRY	No.2	1ST LCASE	MAX./MIN. COMPONENT REACTIONS			LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM			
Q - N	2x4	DRY	No.2	JT COMBINED	SNOW	LIVE	PERM.LIVE	THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015			
N - L	2x4	DRY	No.2	S	1333	888 / 0	0 / 0	THIS DESIGN COMPLIES WITH:			
				L	1333	888 / 0	0 / 0	- PART 9 OF BCBC 2018, OBC 2012, ABC 2019			
ALL WEBS	2x3	DRY	No.2					- PART 9 OF OBC 2012 (2019 AMENDMENT)			
EXCEPT								- CSA 086-09, CSA 088-14			
S - C	2x4	DRY	No.2					- TPIC 2011, TPIC 2014			
I - L	2x4	DRY	No.2					(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD			
								ALLOWABLE DEFL.(LL) = L/360 (1.07")			
								CALCULATED VERT. DEFL.(LL) = 1/999 (0.15")			
								ALLOWABLE DEFL.(TL) = L/360 (1.07")			
								CALCULATED VERT. DEFL.(TL) = 1/999 (0.29")			
								CSI: TO=0.55/1.00 (D-E:1), BC=0.53/1.00 (O-P:1),			
								WB=0.74/1.00 (I-L:1), SS=0.23/1.00 (D-E:1)			
								DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10			
								COMP=1.10 SHEAR=1.10 TENS=1.10			
								COMPANION LIVE LOAD FACTOR = 1.00			
								AUTOSOLVE HEELS OFF			
								TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.			
								NAIL VALUES			
								PLATE GRIP(DRY) SHEAR SECTION			
								(PSI) (PL) (PL)			
								MAX MIN MAX MIN MAX MIN			
								MT20 618 354 1667 798 1987 1658			
								PLATE PLACEMENT TOL. = 0.250 inches			
								PLATE ROTATION TOL. = 5.0 Deg.			
								USI GRIP= 0.84 (D) (INPUT= 0.90)			
								USI METAL= 0.66 (I) (INPUT= 1.00)			


PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMW+p	MT20	3.0	4.0		
C TMW-W	MT20	5.0	8.0		
D TTWW-m	MT20	5.0	8.0	2.25	3.50
E TMW-W	MT20	4.0	4.0		
F TS-I	MT20	3.0	6.0		
G TMW+W	MT20	2.0	4.0		
H TTWW-m	MT20	5.0	8.0	2.25	3.50
I TMW-W	MT20	5.0	8.0		
J TMW+p	MT20	3.0	4.0		
L BMW-W	MT20	4.0	8.0		Edge
M BMW-W	MT20	4.0	4.0		
N BS-I	MT20	3.0	6.0		
O BMW-W	MT20	4.0	8.0		
P BMW-W	MT20	4.0	8.0		
Q BS-I	MT20	3.0	6.0		
R BMW-W	MT20	4.0	4.0		
S BMW-W	MT20	4.0	8.0		Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	MAX	MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	MAX
	FORCE	(PLF)	LC1	CSI (LC)		FORCE	(PLF)	LC1	CSI (LC)
FR-TO	FROM	TO	LENGTH	FR-TO	FROM	TO	LENGTH	FR-TO	FROM
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	C-R	0 / 74	0.03 (4)	
B-C	0 / 17	-91.8	-91.8	0.20 (1)	10.00	R-D	0 / 132	0.04 (4)	
C-D	-2477 / 0	-91.8	-91.8	0.30 (1)	4.11	D-P	0 / 941	0.21 (1)	
D-E	-2908 / 0	-91.8	-91.8	0.55 (1)	3.59	P-E	-537 / 0	0.21 (1)	
E-F	-2908 / 0	-91.8	-91.8	0.54 (1)	3.59	E-O	-2 / 0	0.00 (1)	
F-G	-2908 / 0	-91.8	-91.8	0.54 (1)	3.59	O-G	-536 / 0	0.21 (1)	
G-H	-2908 / 0	-91.8	-91.8	0.54 (1)	3.59	O-H	0 / 939	0.21 (1)	
H-I	-2479 / 0	-91.8	-91.8	0.30 (1)	4.11	H-M	0 / 133	0.04 (4)	
I-J	0 / 17	-91.8	-91.8	0.20 (1)	10.00	M-I	0 / 74	0.03 (4)	
J-K	0 / 28	-91.8	-91.8	0.12 (1)	10.00	S-C	-2874 / 0	0.74 (1)	
S-B	-269 / 0	0.0	0.0	0.03 (1)	7.81	I-L	-2874 / 0	0.74 (1)	
L-J	-269 / 0	0.0	0.0	0.03 (1)	7.81				
S-R	0 / 2174	-18.5	-18.5	0.49 (1)	10.00				
R-Q	0 / 2202	-18.5	-18.5	0.49 (1)	10.00				
Q-P	0 / 2202	-18.5	-18.5	0.49 (1)	10.00				
P-O	0 / 2908	-18.5	-18.5	0.53 (1)	10.00				
O-N	0 / 2202	-18.5	-18.5	0.49 (1)	10.00				
N-M	0 / 2202	-18.5	-18.5	0.49 (1)	10.00				
M-L	0 / 2174	-18.5	-18.5	0.49 (1)	10.00				

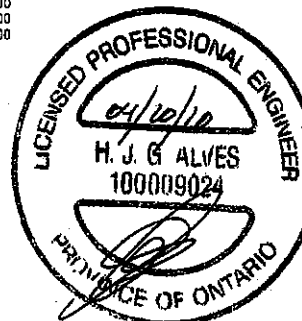

Structural component only
DWG# T-2006377

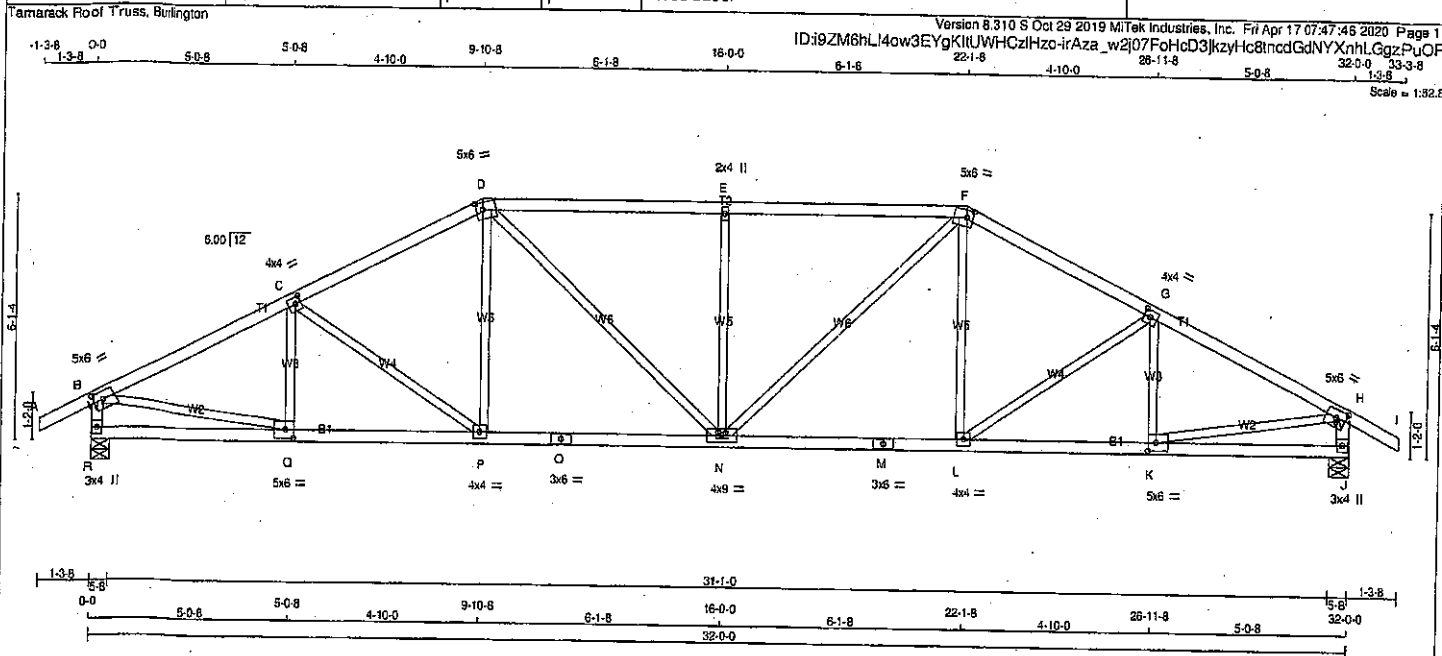

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	6.0	2.25	2.75
C	TMVW-t	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	6.0	2.25	2.00
E	TMVW-t	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.25	2.00
G	TMVW-t	MT20	4.0	4.0	2.00	1.75
H	TMVW-t	MT20	5.0	6.0	2.25	2.75
J	BMV1+p	MT20	3.0	4.0		
K	BMVW-t	MT20	5.0	6.0	2.50	2.50
L	BMVW-t	MT20	4.0	4.0		
M	BS-t	MT20	3.0	6.0		
N	BMVW-t	MT20	4.0	9.0		
O	BS-t	MT20	3.0	6.0		
P	BMVW-t	MT20	4.0	4.0		
Q	BMVW-t	MT20	5.0	6.0	2.50	2.50
R	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
R	1889	0	1889	0	5-8	5-8
J	1889	0	1889	0	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	MAX. MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1333	898 / 0	0 / 0	0 / 0	0 / 0	445 / 0	0 / 0
J	1333	898 / 0	0 / 0	0 / 0	0 / 0	445 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.80 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LCT (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LCT (LC)	UNBRACED LENGTH (FT)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	C-C	-302 / 0	0.07 (1)
B-C	-2546 / 0	-91.8	-91.8 0.37 (1)	4.01	C-P	-263 / 0	0.16 (1)
C-D	-2351 / 0	-91.8	-91.8 0.35 (1)	4.18	P-D	0 / 257	0.06 (1)
D-E	-2507 / 0	-91.8	-91.8 0.54 (1)	3.60	D-N	0 / 581	0.13 (1)
E-F	-2507 / 0	-91.8	-91.8 0.35 (1)	3.80	N-E	-590 / 0	0.40 (1)
F-G	-2351 / 0	-91.8	-91.8 0.35 (1)	4.16	N-F	0 / 581	0.13 (1)
G-H	-2546 / 0	-91.8	-91.8 0.37 (1)	4.01	F-F	0 / 257	0.06 (1)
H-I	0 / 28	-91.8	-91.8 0.12 (1)	10.00	L-G	-263 / 0	0.16 (1)
I-B	-1845 / 0	0.0	0.0 0.19 (1)	6.18	K-G	-302 / 0	0.07 (1)
J-H	-1845 / 0	0.0	0.0 0.19 (1)	6.18	B-Q	0 / 2330	0.52 (1)
R-Q	0 / 0	-18.5	-18.5 0.10 (4)	10.00	K-H	0 / 2330	0.52 (1)
Q-P	0 / 2297	-18.5	-18.5 0.44 (1)	10.00			
P-O	0 / 2085	-18.5	-18.5 0.40 (1)	10.00			
O-N	0 / 2085	-18.5	-18.5 0.40 (1)	10.00			
N-M	0 / 2085	-18.5	-18.5 0.40 (1)	10.00			
M-L	0 / 2085	-18.5	-18.5 0.40 (1)	10.00			
L-K	0 / 2297	-18.5	-18.5 0.44 (1)	10.00			
K-J	0 / 0	-18.5	-18.5 0.10 (4)	10.00			

TOTAL WEIGHT = 129 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 089-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.07")
CALCULATED VERT. DEFL.(LL) = L/999 (0.13")
ALLOWABLE DEFL.(TL) = L/360 (1.07")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.54/1.00 (D-E:1), BC=0.44/1.00 (P-O:1), WB=0.52/1.00 (B-Q:1), SS=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.68 (H) (INPUT = 1.00)

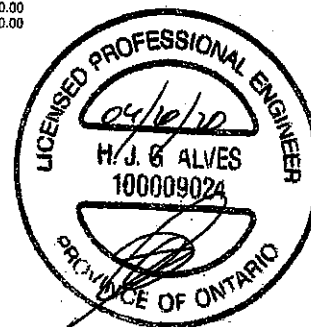

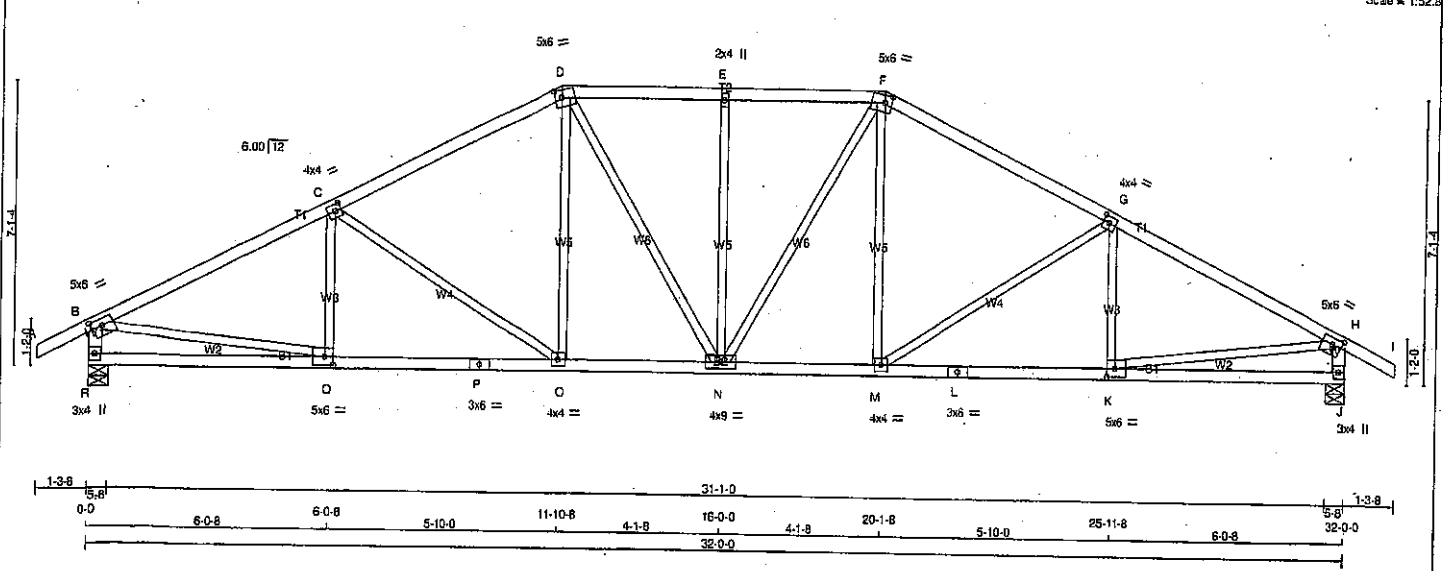

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				TOTAL WEIGHT = 136 lb			
N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.	BEARINGS				DESIGN CRITERIA		
A - D	2x4	DRY	No.2	SPF	FACTORED	MAXIMUM FACTORED	INPUT	REQD	SPECIFIED LOADS:		
D - F	2x4	DRY	No.2	SPF	GROSS REACTION	GROSS REACTION	BRG	BRG	TOP CH. LL = 25.6 PSF		
F - I	2x4	DRY	No.2	SPF	VERT	DOWN	UP	IN-SX	DL = 6.0 PSF		
I - B	2x4	DRY	No.2	SPF	1889	0	0	5-8	BOT CH. LL = 0.0 PSF		
B - H	2x4	DRY	No.2	SPF	1889	0	0	5-8	DL = 7.4 PSF		
H - P	2x4	DRY	No.2	SPF					TOTAL LOAD = 39.0 PSF		
P - L	2x4	DRY	No.2	SPF					SPACING = 24.0 IN. C/C		
L - J	2x4	DRY	No.2	SPF					LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM		
ALL WEBS	2x3	DRY	No.2	SPF	UNFACTORED REACTIONS				THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015		
EXCEPT					1ST CASE	MAX. MIN. COMPONENT REACTIONS			THIS DESIGN COMPLIES WITH:		
DRY, SEASONED LUMBER.					JT COMBINED	SNOW	LIVE	PERM. LIVE	- PART 9 OF CBC 2018, OBC 2012, ABC 2019		
					R	1333	888 / 0	0 / 0	- PART 9 OF OBC 2012 (2019 AMENDMENT)		
					J	1333	888 / 0	0 / 0	- CSA 088-09, CSA 088-14		
									- TPIC 2011, TPIC 2014		
									(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD		

PLATES (table is in inches)						CHORDS					
JT	TYPE	PLATES	W	LEN	Y	X	MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	UNBRAC LENGTH
B	TMVW-I	MT20	5.0	6.0	2.00	2.75	A-B	0 / 28	-91.8	-91.8	0.12 (1)
C	TMVW-I	MT20	4.0	4.0	2.00	1.75	B-C	-2587 / 0	-91.8	-91.8	0.55 (1)
D	TTWW-m	MT20	5.0	8.0	2.25	2.00	C-D	-2197 / 0	-91.8	-91.8	0.49 (1)
E	TMVW-w	MT20	2.0	4.0			D-E	-2089 / 0	-91.8	-91.8	0.24 (1)
F	TTWW-m	MT20	5.0	6.0	2.25	2.00	E-F	-2089 / 0	-91.8	-91.8	0.24 (1)
G	TMVW-I	MT20	4.0	4.0	2.00	1.75	F-G	-2197 / 0	-91.8	-91.8	0.49 (1)
H	TMVW-I	MT20	5.0	8.0	2.00	2.75	G-H	-2587 / 0	-91.8	-91.8	0.55 (1)
J	BMV1-p	MT20	3.0	4.0			H-I	0 / 28	-91.8	-91.8	0.12 (1)
K	BMVW-I	MT20	5.0	6.0	2.50	2.50	I-B	-1840 / 0	0.0	0.0	0.19 (1)
L	BS-I	MT20	3.0	6.0			J-H	-1840 / 0	0.0	0.0	0.19 (1)
M	BMVW-I	MT20	4.0	4.0			R-O	0 / 0	-18.5	-18.5	0.15 (4)
N	BMVW-I	MT20	4.0	4.0			Q-P	0 / 2339	-18.5	-18.5	0.44 (1)
O	BMVW-I	MT20	4.0	4.0			P-O	0 / 2339	-18.5	-18.5	0.44 (1)
P	BS-I	MT20	3.0	6.0			Q-N	0 / 1943	-18.5	-18.5	0.37 (1)
Q	BMVW-I	MT20	5.0	6.0	2.50	2.50	N-M	0 / 1943	-18.5	-18.5	0.37 (1)
R	BMV1-p	MT20	3.0	4.0			M-L	0 / 2339	-18.5	-18.5	0.44 (1)
							L-K	0 / 2339	-18.5	-18.5	0.44 (1)
							K-J	0 / 0	-18.5	-18.5	0.15 (4)

ALLOWABLE DEFL. (LL) = L/360 (1.07")

CALCULATED VERT. DEFL. (LL) = L/999 (0.12")

ALLOWABLE DEFL. (TL) = L/360 (1.07")

CALCULATED VERT. DEFL. (TL) = L/999 (0.21")

CS: TC=0.55/1.00 (B-C:1), BC=0.44/1.00 (O-Q:1), WB=0.59/1.00 (H-K:1), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX	MIN	MAX
618	354	1667


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


ISI GRIP = 0.88 (B) (INPUT = 0.90)

ISI METAL = 0.74 (P) (INPUT = 1.00)

Structural component only
DWG# T-2006379

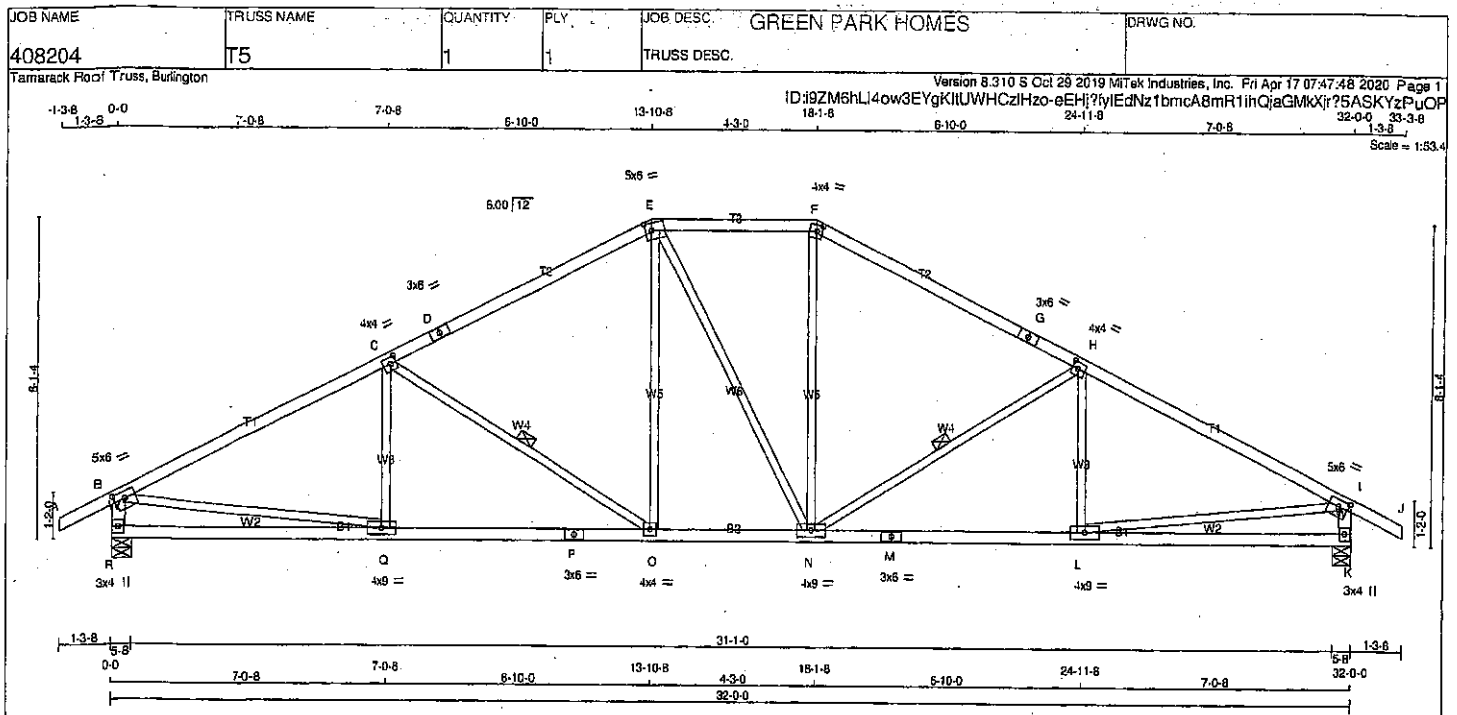

LUMBER N. L. G. A. RULES CHORDS SIZE A - D 2x4 DRY No.2 E - F 2x4 DRY No.2 G - H 2x4 DRY No.2 I - J 2x4 DRY No.2 K - L 2x4 DRY No.2 M - N 2x4 DRY No.2 O - P 2x4 DRY No.2 Q - R 2x4 DRY No.2 ALL WEBS 2x3 DRY No.2 EXCEPT DRY: SEASONED LUMBER.			DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2018, CBC 2012, ABC 2019 - PART 9 OF CBC 2012 (2019 AMENDMENT) - CSA 088-09, CSA 088-14 - TPIC 2011, TPIC 2014 (55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) ALLOWABLE DEFL.(LL) = L/360 (1.07") CALCULATED VERT. DEFL.(LL) = L/999 (0.12") ALLOWABLE DEFL.(TL) = L/360 (1.07") CALCULATED VERT. DEFL.(TL) = L/999 (0.24") CSI: TC=0.78/1.00 (B-C:1), BC=0.46/1.00 (C-Q:1), WB=0.53/1.00 (B-Q:1), SS=0.28/1.00 (B-C:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 1.00 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1657 788 1987 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.89 (B) (INPUT = 0.90) JSI METAL= 0.77 (P) (INPUT = 1.00)																																																																																																																																																																																																
PLATES (table is in inches) JT TYPE PLATES W LEN Y X B TMWW-t MT20 5.0 6.0 2.00 2.75 C TMWW-t MT20 4.0 4.0 2.00 1.75 D TS-t MT20 3.0 6.0 E TTWW-m MT20 5.0 6.0 2.25 2.00 F TTWW-m MT20 4.0 4.0 2.00 1.75 G TS-t MT20 3.0 6.0 H TMWW-t MT20 4.0 4.0 2.00 1.75 I TMWW-t MT20 5.0 6.0 2.00 2.75 K BMV1+p MT20 3.0 4.0 L BMWW-t MT20 4.0 9.0 M BS-t MT20 3.0 6.0 N BMWW-t MT20 4.0 9.0 O BMWW-t MT20 4.0 4.0 P BS-t MT20 3.0 6.0 Q BMWW-t MT20 4.0 9.0 R BMV1+p MT20 3.0 4.0			DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED GROSS REACTION JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX R 1889 0 1889 0 0 5-8 5-8 K 1889 0 1889 0 0 5-8 5-8 UNFACTORED REACTIONS 1ST CASE MAX/MIN COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL R 1333 888/0 0/0 0/0 0/0 445/0 0/0 K 1333 888/0 0/0 0/0 0/0 445/0 0/0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED. 1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-N. END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW LOADING TOTAL LOAD CASES: (4) <table> <tr> <th>CHORDS</th><th>MEMB.</th><th>MAX. FACTORED FORCE (LBS)</th><th>FACTORED VERT. LOAD (PL)</th><th>MAX. FACTORED CSI (LC)</th><th>UNBRACED LENGTH</th><th>FR-TO</th><th>MEMB.</th><th>MAX. FACTORED FORCE (LBS)</th><th>MAX. FACTORED CSI (LC)</th></tr> <tr> <td>A-B</td><td>0/28</td><td>-91.8</td><td>-91.8</td><td>0.12 (1)</td><td>10.00</td><td>Q-C</td><td>-141/71</td><td>0.05 (1)</td><td></td></tr> <tr> <td>B-C</td><td>-2595/0</td><td>-91.8</td><td>-91.8</td><td>0.78 (1)</td><td>3.47</td><td>C-D</td><td>-680/0</td><td>0.31 (1)</td><td></td></tr> <tr> <td>C-D</td><td>-2022/0</td><td>-91.8</td><td>-91.8</td><td>0.68 (1)</td><td>3.97</td><td>D-E</td><td>0/458</td><td>0.10 (1)</td><td></td></tr> <tr> <td>D-E</td><td>-2022/0</td><td>-91.8</td><td>-91.8</td><td>0.68 (1)</td><td>3.97</td><td>E-F</td><td>0/2</td><td>0.00 (1)</td><td></td></tr> <tr> <td>E-F</td><td>-1783/0</td><td>-91.8</td><td>-91.8</td><td>0.25 (1)</td><td>4.77</td><td>F-G</td><td>0/460</td><td>0.10 (1)</td><td></td></tr> <tr> <td>F-G</td><td>-2023/0</td><td>-91.8</td><td>-91.8</td><td>0.68 (1)</td><td>3.97</td><td>G-H</td><td>-679/0</td><td>0.31 (1)</td><td></td></tr> <tr> <td>G-H</td><td>-2023/0</td><td>-91.8</td><td>-91.8</td><td>0.68 (1)</td><td>3.97</td><td>H-I</td><td>-143/70</td><td>0.05 (1)</td><td></td></tr> <tr> <td>H-I</td><td>-2585/0</td><td>-91.8</td><td>-91.8</td><td>0.78 (1)</td><td>3.47</td><td>I-J</td><td>0/2369</td><td>0.53 (1)</td><td></td></tr> <tr> <td>I-J</td><td>0/28</td><td>-91.8</td><td>-91.8</td><td>0.12 (1)</td><td>10.00</td><td>J-K</td><td>0/2368</td><td>0.53 (1)</td><td></td></tr> <tr> <td>J-K</td><td>-1834/0</td><td>0.0</td><td>0.0</td><td>0.19 (1)</td><td>6.18</td><td></td><td></td><td></td><td></td></tr> <tr> <td>K-L</td><td>-1834/0</td><td>0.0</td><td>0.0</td><td>0.19 (1)</td><td>6.18</td><td></td><td></td><td></td><td></td></tr> <tr> <td>L-M</td><td>0/0</td><td>-18.5</td><td>-18.5</td><td>0.22 (4)</td><td>10.00</td><td></td><td></td><td></td><td></td></tr> <tr> <td>M-N</td><td>0/2351</td><td>-18.5</td><td>-18.5</td><td>0.48 (1)</td><td>10.00</td><td></td><td></td><td></td><td></td></tr> <tr> <td>N-O</td><td>0/2351</td><td>-18.5</td><td>-18.5</td><td>0.48 (1)</td><td>10.00</td><td></td><td></td><td></td><td></td></tr> <tr> <td>O-P</td><td>0/1783</td><td>-18.5</td><td>-18.5</td><td>0.35 (1)</td><td>10.00</td><td></td><td></td><td></td><td></td></tr> <tr> <td>P-Q</td><td>0/2351</td><td>-18.5</td><td>-18.5</td><td>0.48 (1)</td><td>10.00</td><td></td><td></td><td></td><td></td></tr> <tr> <td>Q-R</td><td>0/2351</td><td>-18.5</td><td>-18.5</td><td>0.48 (1)</td><td>10.00</td><td></td><td></td><td></td><td></td></tr> <tr> <td>R-S</td><td>0/0</td><td>-18.5</td><td>-18.5</td><td>0.22 (4)</td><td>10.00</td><td></td><td></td><td></td><td></td></tr> </table>			CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. FACTORED CSI (LC)	UNBRACED LENGTH	FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	A-B	0/28	-91.8	-91.8	0.12 (1)	10.00	Q-C	-141/71	0.05 (1)		B-C	-2595/0	-91.8	-91.8	0.78 (1)	3.47	C-D	-680/0	0.31 (1)		C-D	-2022/0	-91.8	-91.8	0.68 (1)	3.97	D-E	0/458	0.10 (1)		D-E	-2022/0	-91.8	-91.8	0.68 (1)	3.97	E-F	0/2	0.00 (1)		E-F	-1783/0	-91.8	-91.8	0.25 (1)	4.77	F-G	0/460	0.10 (1)		F-G	-2023/0	-91.8	-91.8	0.68 (1)	3.97	G-H	-679/0	0.31 (1)		G-H	-2023/0	-91.8	-91.8	0.68 (1)	3.97	H-I	-143/70	0.05 (1)		H-I	-2585/0	-91.8	-91.8	0.78 (1)	3.47	I-J	0/2369	0.53 (1)		I-J	0/28	-91.8	-91.8	0.12 (1)	10.00	J-K	0/2368	0.53 (1)		J-K	-1834/0	0.0	0.0	0.19 (1)	6.18					K-L	-1834/0	0.0	0.0	0.19 (1)	6.18					L-M	0/0	-18.5	-18.5	0.22 (4)	10.00					M-N	0/2351	-18.5	-18.5	0.48 (1)	10.00					N-O	0/2351	-18.5	-18.5	0.48 (1)	10.00					O-P	0/1783	-18.5	-18.5	0.35 (1)	10.00					P-Q	0/2351	-18.5	-18.5	0.48 (1)	10.00					Q-R	0/2351	-18.5	-18.5	0.48 (1)	10.00					R-S	0/0	-18.5	-18.5	0.22 (4)	10.00				
CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. FACTORED CSI (LC)	UNBRACED LENGTH	FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)																																																																																																																																																																																										
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00	Q-C	-141/71	0.05 (1)																																																																																																																																																																																											
B-C	-2595/0	-91.8	-91.8	0.78 (1)	3.47	C-D	-680/0	0.31 (1)																																																																																																																																																																																											
C-D	-2022/0	-91.8	-91.8	0.68 (1)	3.97	D-E	0/458	0.10 (1)																																																																																																																																																																																											
D-E	-2022/0	-91.8	-91.8	0.68 (1)	3.97	E-F	0/2	0.00 (1)																																																																																																																																																																																											
E-F	-1783/0	-91.8	-91.8	0.25 (1)	4.77	F-G	0/460	0.10 (1)																																																																																																																																																																																											
F-G	-2023/0	-91.8	-91.8	0.68 (1)	3.97	G-H	-679/0	0.31 (1)																																																																																																																																																																																											
G-H	-2023/0	-91.8	-91.8	0.68 (1)	3.97	H-I	-143/70	0.05 (1)																																																																																																																																																																																											
H-I	-2585/0	-91.8	-91.8	0.78 (1)	3.47	I-J	0/2369	0.53 (1)																																																																																																																																																																																											
I-J	0/28	-91.8	-91.8	0.12 (1)	10.00	J-K	0/2368	0.53 (1)																																																																																																																																																																																											
J-K	-1834/0	0.0	0.0	0.19 (1)	6.18																																																																																																																																																																																														
K-L	-1834/0	0.0	0.0	0.19 (1)	6.18																																																																																																																																																																																														
L-M	0/0	-18.5	-18.5	0.22 (4)	10.00																																																																																																																																																																																														
M-N	0/2351	-18.5	-18.5	0.48 (1)	10.00																																																																																																																																																																																														
N-O	0/2351	-18.5	-18.5	0.48 (1)	10.00																																																																																																																																																																																														
O-P	0/1783	-18.5	-18.5	0.35 (1)	10.00																																																																																																																																																																																														
P-Q	0/2351	-18.5	-18.5	0.48 (1)	10.00																																																																																																																																																																																														
Q-R	0/2351	-18.5	-18.5	0.48 (1)	10.00																																																																																																																																																																																														
R-S	0/0	-18.5	-18.5	0.22 (4)	10.00																																																																																																																																																																																														

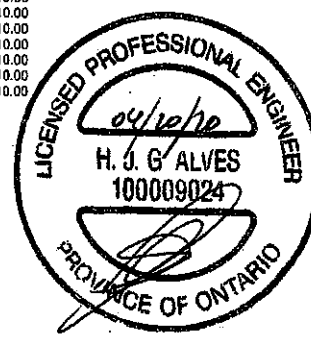

Structural component only
DWG# T-2006380

Famarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Fri Apr 17 07:47:49 2020 Page 1
ID:19ZM6hLl4ow3EYgKtUWHHCzH1zo-6Qr5C?zx?vVqllLokrigawcis_b7T_f?Dlw?s_zPuOC
1-3-8 0-0 5-5-11 5-3-3 10-8-13 16-0-0 21-3-3 5-3-3 5-3-3 22-6-5 32-0-0 33-3-8
1-3-8 5-5-11 1-3-8



<u>BEARINGS</u>							
	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INFLT BRG	REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
R	1889	0	1889	0	0	5-8	5-8
L	1889	0	1889	0	0	5-8	5-8

<u>UNFACTORED REACTIONS</u>							
	1ST CASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
JT		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1333	888 / 0	0 / 0	0 / 0	0 / 0	445 / 0	0 / 0
L	1333	888 / 0	0 / 0	0 / 0	0 / 0	445 / 0	0 / 0

BEARING MATERIAL TO BE SPREAD OR BETTER AT JOINTS

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9.
NBCC 2010, NBCC 2015

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.10 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.07")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL)= L/360 (1.07")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.37/1.00 (C-E:1), BC=0.51/1.00 (Q-R:1),
WB=0.55/1.00 (C-R:1), SSI=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION

	(PS)	(PL)	(PL)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1556


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.	
--------------------------------	--

JSI GRIP= 0.85 (C) (INPUT = 0.90)
JSI METAL= 0.70 (F) (INPUT = 1.00)

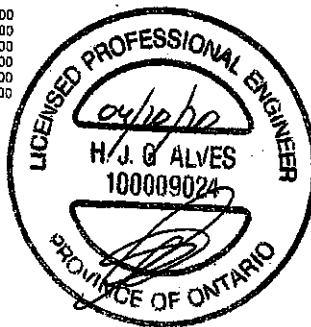

Structural component only
DWG# T-2006381

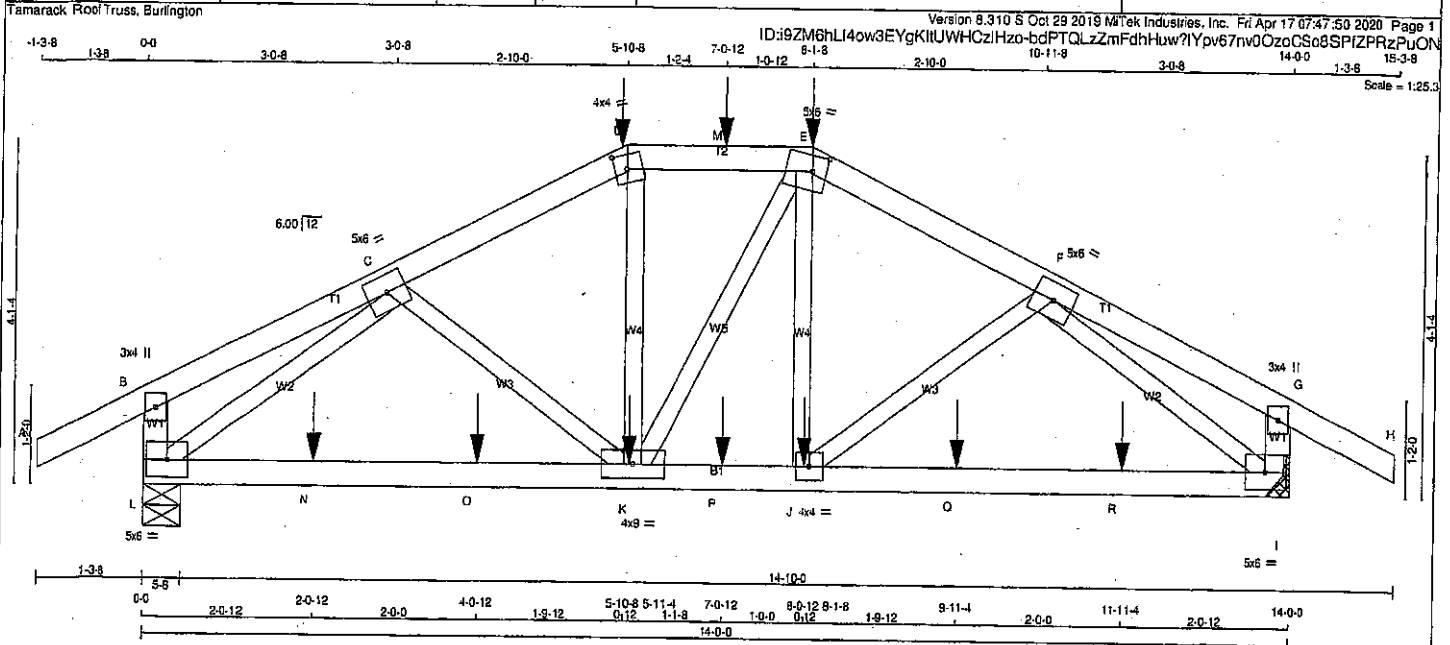

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - H	2x4	DRY	No.2	SPF
L - B	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF
L - I	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-I	MT20	5.0	6.0		
D	TTW-m	MT20	4.0	4.0	2.00	1.75
E	TTWW-m	MT20	5.0	6.0	2.25	2.00
F	TMVW-I	MT20	5.0	6.0		
G	TMV+p	MT20	3.0	4.0		
I	BMVW-I	MT20	5.0	6.0		
J	BMVW-I	MT20	4.0	4.0		
K	BMVW-I	MT20	4.0	9.0		
L	BMVW-I	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT REQRD
JT VERT	DOWN	BRG
L 1502	0	5-8
I 1503	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS
L	1060	710 / 0
I	1060	711 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.81 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED (LBS)	MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED (LBS)
FR-TO	0 / 28	-91.8	-91.8	FR-TO	0 / 120	0.03	0.03
A-B	0 / 10	-91.8	-91.8	C-K	0 / 126	0.05	0.05
B-C	0 / 10	-91.8	-91.8	K-E	-3 / 0	0.00	0.00
C-D	-1810 / 0	-91.8	-91.8	E-J	0 / 126	0.05	0.05
D-M	-1810 / 0	-91.8	-91.8	J-F	0 / 120	0.03	0.03
M-E	-1810 / 0	-91.8	-91.8	F-L	-1929 / 0	0.50	0.50
E-F	-1812 / 0	-91.8	-91.8	L-C	-1931 / 0	0.50	0.50
F-G	0 / 10	-91.8	-91.8				
G-H	0 / 28	-91.8	-91.8				
H-I	-237 / 0	0.0	0.0				
I-G	-237 / 0	0.0	0.0				

LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
JT	5-10-8	-459	-459	FRONT	VERT	TOTAL	---	C1
D	8-1-8	-459	-459	FRONT	VERT	TOTAL	---	C1
E	8-0-12	-26	-26	FRONT	VERT	TOTAL	---	C1
K	5-11-4	-26	-26	FRONT	VERT	TOTAL	---	C1
M	7-0-12	-110	-110	FRONT	VERT	TOTAL	---	C1
N	2-0-12	-26	-26	FRONT	VERT	TOTAL	---	C1
O	4-0-12	-26	-26	FRONT	VERT	TOTAL	---	C1
P	7-0-12	-26	-26	FRONT	VERT	TOTAL	---	C1
Q	9-11-4	-26	-26	FRONT	VERT	TOTAL	---	C1
R	11-11-4	-26	-26	FRONT	VERT	TOTAL	---	C1

FACTORED CONCENTRATED LOADS (LBS)

LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
JT	5-10-8	-459	-459	FRONT	VERT	TOTAL	---	C1
D	8-1-8	-459	-459	FRONT	VERT	TOTAL	---	C1
E	8-0-12	-26	-26	FRONT	VERT	TOTAL	---	C1
K	5-11-4	-26	-26	FRONT	VERT	TOTAL	---	C1
M	7-0-12	-110	-110	FRONT	VERT	TOTAL	---	C1
N	2-0-12	-26	-26	FRONT	VERT	TOTAL	---	C1
O	4-0-12	-26	-26	FRONT	VERT	TOTAL	---	C1
P	7-0-12	-26	-26	FRONT	VERT	TOTAL	---	C1
Q	9-11-4	-26	-26	FRONT	VERT	TOTAL	---	C1
R	11-11-4	-26	-26	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.47")
CALCULATED VERT. DEFL.(LL) = L/959 (0.04")
ALLOWABLE DEFL.(TL) = L/360 (0.47")
CALCULATED VERT. DEFL.(TL) = L/959 (0.10")

CSI: TC=0.21/1.00 (D-E:1), EC=0.42/1.00 (I-J:1),
WB=0.50/1.00 (F-I:1), SSI=0.14/1.00 (K-L:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.81 (D) (INPUT = 0.90)
JSI METAL= 0.49 (F) (INPUT = 1.00)

Structural component only
DWG# T-2006382

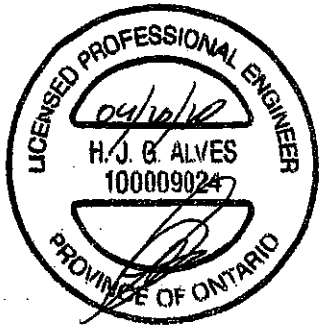

JOB NAME 408204	TRUSS NAME T8	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 07:47:51 2020 Page 1
 ID:9ZM6hL4ow3EYgKltUWHCzHzo-3pzsdh_BXYTu2VBsGK8fLJ5ToLbxyHh3P6xtzPuOM

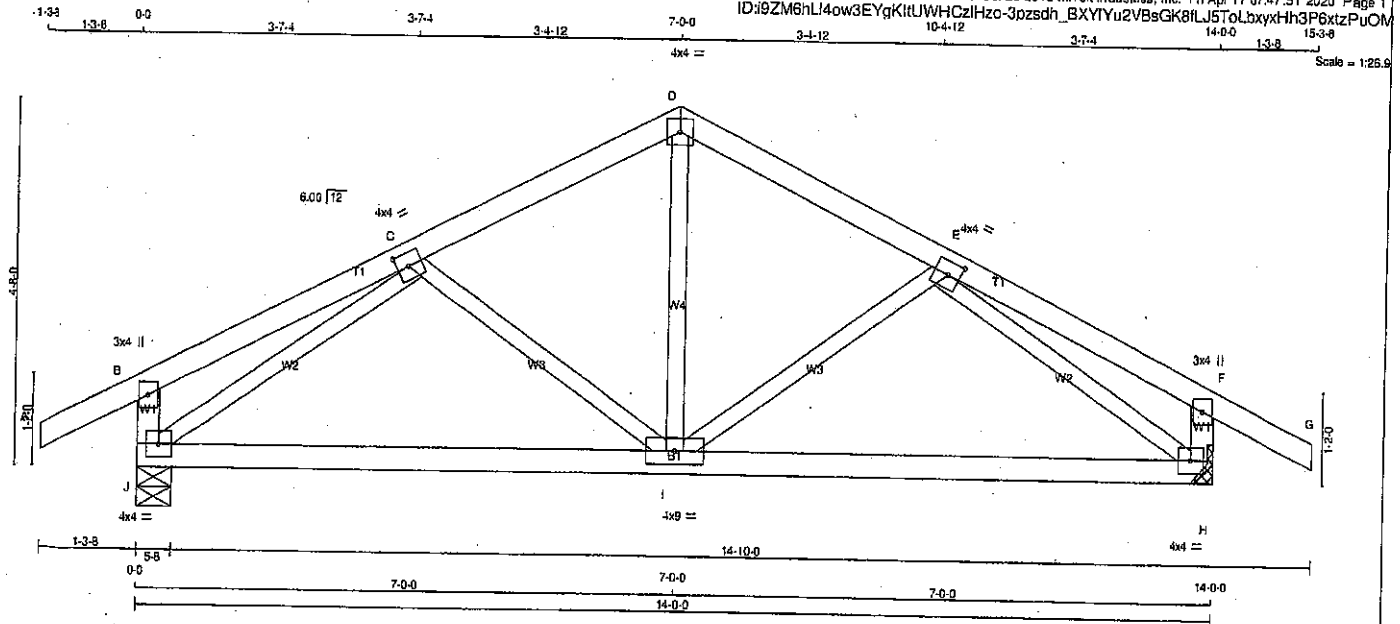

LUMBER			
N.L.G.A. RULES	SIZE	DRY	LUMBER
CHORDS			
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2

ALL WEBS 2x4 DRY No.2
 EXCEPT
 DRY: SEASONED LUMBER.

PLATES (tablets in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMV+p	MT20	3.0	4.0	
C TMWW-t	MT20	4.0	4.0	2.00 1.75
D TTV-p	MT20	4.0	4.0	
E TMWW-t	MT20	4.0	4.0	2.00 1.75
F TMV+p	MT20	3.0	4.0	
H BMVW1-t	MT20	4.0	4.0	
I BMWWW-t	MT20	4.0	9.0	
J BMVW1-t	MT20	4.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
JT	VERT	HORZ	HORZ	UPLIFT	IN-SX
J	896	0	896	0	5-8
H	896	0	896	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	COMBINED	428 / 0	0 / 0	0 / 0	0 / 0	0 / 0	204 / 0	0 / 0
H	COMBINED	428 / 0	0 / 0	0 / 0	0 / 0	0 / 0	204 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	0 / 28	I-D	0 / 394
B-C	0 / 16	I-E	-196 / 0
C-D	-735 / 0	C-I	-196 / 0
D-E	-735 / 0	J-C	-997 / 0
E-F	0 / 16	E-H	-997 / 0
F-G	0 / 28		
J-B	-251 / 0		
H-F	-251 / 0		
J-I	0 / 800		
I-H	0 / 800		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
 BOT CH. LL = 6.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2015, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.47")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
 ALLOWABLE DEFL.(TL) = L/360 (0.47")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.07")

CSI: TC=0.17/1.00 (E-F:1), BC=0.32/1.00 (H-I:4), WB=0.31/1.00 (E-H:1), SS=0.14/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 518 354 1657 788 1967 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.89 (H) (INPUT = 0.90)
 JSI METAL= 0.34 (E) (INPUT = 1.00)

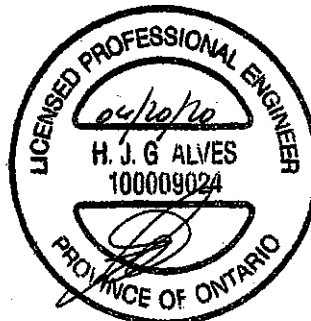

Structural component only
 DWG# T-2006383

JOB NAME 408204	TRUSS NAME T9	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 07:47:53 2020 Page 1
 ID: 9ZM6hL4ow3EYgKILUWHCzHzo-7C5c2N0R3A7F8MeazhMkmpCnb2OPqLa8NuD0mzPuOK
 1-3-8 0-0 5-2-7 5-5-0 10-7-7 5-3-12 15-11-2 2-7-14 18-7-6 21-2-14 5-3-12 25-6-9 5-5-0 31-11-8 5-2-7 37-2-0 38-5-8 1-3-8
 Scale = 1:60.6

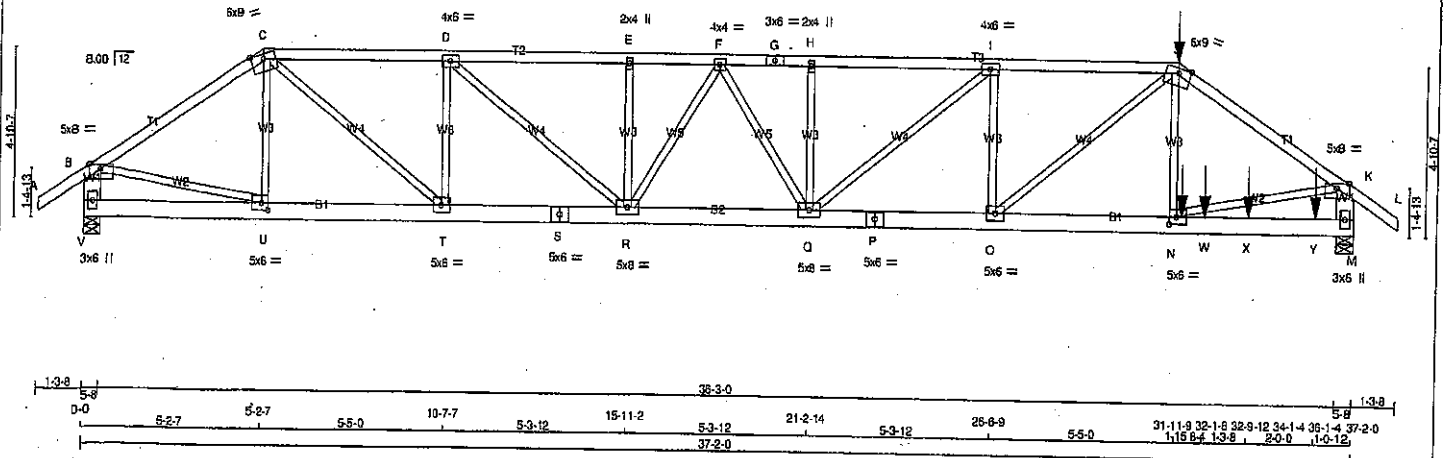

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - G	2x4	DRY No.2	SPF
G - J	2x4	DRY No.2	SPF
J - L	2x4	DRY No.2	SPF
V - B	2x6	DRY No.2	SPF
M - K	2x6	DRY No.2	SPF
V - S	2x6	DRY 1650F 1.5E	SPF
S - P	2x6	DRY 1650F 1.5E	SPF
P - M	2x6	DRY 1650F 1.5E	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
A-C 1	12	TOP
C-G 1	12	TOP
G-J 1	12	SIDE(61.0)
J-L 1	12	SIDE(61.0)
V-B 2	12	TOP
M-K 2	12	TOP
V-S 2	12	TOP
S-P 2	12	TOP
P-M 2	12	SIDE(183.1)
WEBS: (0.122"x3") SPIRAL NAILS		
N-J 1	6	SIDE(132.7)
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMWV-p	MT20	5.0	8.0	Edge	
C TTMW-m	MT20	6.0	9.0	Edge	
D TMWV-l	MT20	4.0	6.0		
E TMWV-w	MT20	2.0	4.0		
F TMWV-l	MT20	4.0	4.0		
G TS-l	MT20	3.0	6.0		
H TMWV-w	MT20	2.0	4.0		
I TMWV-l	MT20	4.0	6.0		
J TTMW-m	MT20	6.0	9.0	Edge	
K TMWV-p	MT20	5.0	8.0	Edge	
M BMWV-l	MT20	3.0	6.0		
N BMWV-l	MT20	5.0	6.0	2.50	2.50
O BMWV-l	MT20	5.0	6.0		
P BS-l	MT20	5.0	6.0		
Q BMWVW-l	MT20	5.0	8.0		
R BMWVW-l	MT20	5.0	8.0		
S BS-l	MT20	5.0	6.0		
T BMWV-l	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD IN-SX
JT VERT	2385	0	0	5-8
V	2385	0	0	5-8
M	3468	0	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
V	1684	1122 / 0	0 / 0	0 / 0	0 / 0
M	2446	1631 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.97 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	UNBRACED LENGTH	WEBS MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO						
A-B	0 / 35	-91.8	-91.8	0.07 (1)	10.00	U-C -318 / 0
B-C	-2778 / 0	-91.8	-91.8	0.30 (1)	5.18	C-T 0 -2222 / 0
C-D	-4013 / 0	-91.8	-91.8	0.32 (1)	4.46	T-D -1323 / 0
D-E	-4910 / 0	-91.8	-91.8	0.35 (1)	4.08	D-R 0 / 1175
E-F	-4910 / 0	-91.8	-91.8	0.18 (1)	4.22	R-E -373 / 0
F-G	-5158 / 0	-91.8	-91.8	0.19 (1)	4.13	Q-H -373 / 0
G-H	-5158 / 0	-91.8	-91.8	0.19 (1)	4.13	Q-I 0 / 523
H-I	-5158 / 0	-91.8	-91.8	0.37 (1)	3.97	I-O -898 / 0
I-J	-4759 / 0	-91.8	-91.8	0.35 (1)	4.13	O-J 0 / 1580
J-K	-4244 / 0	-91.8	-91.8	0.37 (1)	4.32	N-J 0 / 687
K-L	0 / 35	-91.8	-91.8	0.07 (1)	10.00	B-U 0 / 2349
V-B	-2344 / 0	0.0	0.0	0.08 (1)	7.81	N-K 0 / 3589
M-K	-3388 / 0	0.0	0.0	0.12 (1)	7.57	R-F -342 / 0
V-U	0 / 0	-18.5	-18.5	0.02 (4)	10.00	F-Q 0 / 147
U-T	0 / 2301	-18.5	-18.5	0.11 (1)	10.00	
T-S	0 / 4013	-18.5	-18.5	0.19 (1)	10.00	
S-R	0 / 4013	-18.5	-18.5	0.19 (1)	10.00	
R-Q	0 / 5084	-18.5	-18.5	0.23 (1)	10.00	
Q-P	0 / 4759	-18.5	-18.5	0.22 (1)	10.00	
P-O	0 / 4759	-18.5	-18.5	0.22 (1)	10.00	
O-N	0 / 3542	-18.5	-18.5	0.16 (1)	10.00	
N-W	0 / 0	-18.5	-18.5	0.03 (4)	10.00	
W-X	0 / 0	-18.5	-18.5	0.03 (4)	10.00	
X-Y	0 / 0	-18.5	-18.5	0.03 (4)	10.00	
Y-M	0 / 0	-18.5	-18.5	0.03 (4)	10.00	

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.
J	31-11-9	-44	-49	---	FRONT	VERT
J	31-11-9	-195	-195	---	FRONT	VERT
N	32-1-8	-1210	-1210	---	FRONT	VERT
W	32-9-12	-17	-17	---	FRONT	VERT
X	34-1-4	-17	-17	---	FRONT	VERT
Y	35-1-4	-17	-17	---	FRONT	VERT

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 176 = 352 LB

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL	= 6.0	PSF
BOT CH.	LL = 0.0	PSF
DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.24")
CALCULATED VERT. DEFL.(LL) = L/989 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (1.24")
CALCULATED VERT. DEFL.(TL) = L/989 (0.28")

CSI: TC=0.37/1.00 (H-I:1), BC=0.23/1.00 (Q-R:1), WB=0.44/1.00 (K-N:1), SSI=0.13/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PLI)	SECTION (PLI)
MT20	618	354
	1667	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.71 (U) (INPUT = 0.90)
JSI METAL = 0.44 (S) (INPUT = 1.00)

Structural component only

DWG# T-2006384

CONTINUED ON PAGE 2


JOB NAME 408204	TRUSS NAME T9	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Pool Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 07:47:53 2020 Page 2
 ID:9ZM6hLi4ow3EYqKtUWHCzIHzo-7C5e2N0R3A?F8MeazhMckmPQnb2OPqLa8NuD0mzPuOK

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
U	BMW	W4	MT20	5.0	6.0	2.50 2.50
V	BMW	1+p	MT20	3.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE
 TOUCHES EDGE OF CHORD.

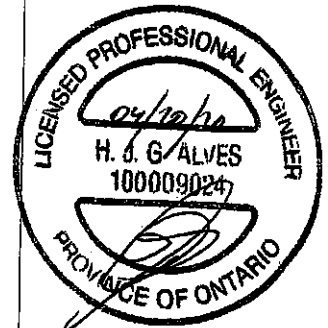


Structural component only
 DWG# T-2006384

Handwritten initials

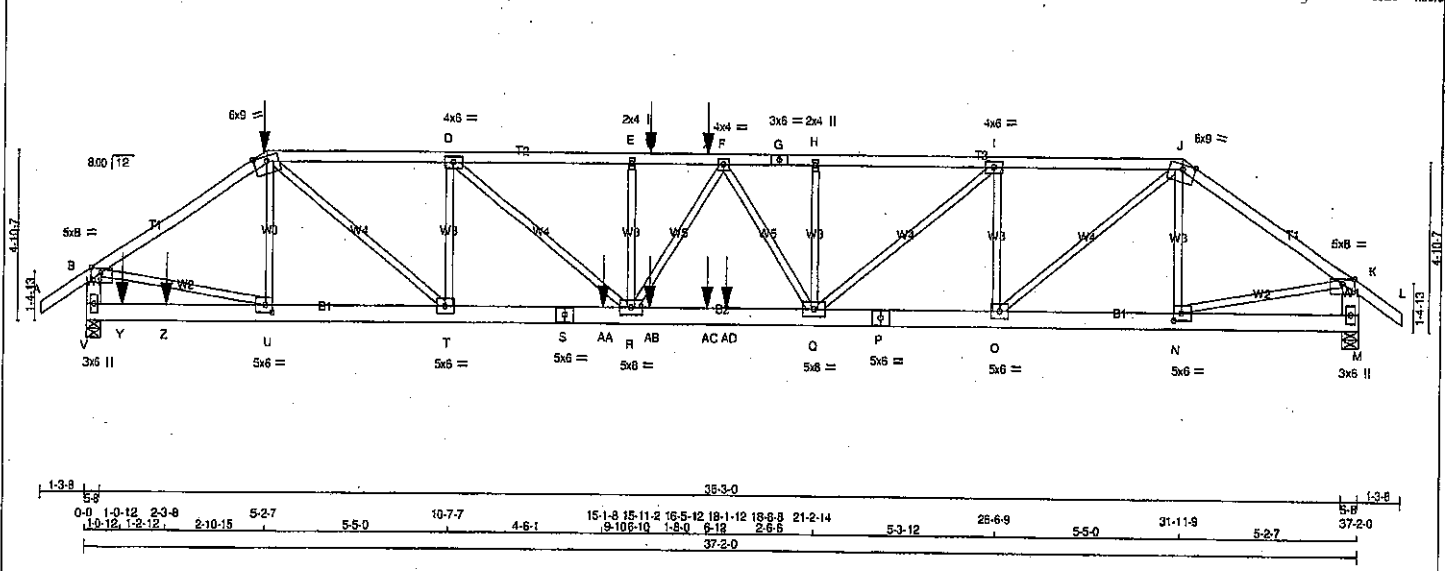

LUMBER N.L.G.A. RULES CHORDS SIZE LUMBER DESCR. SPF A - C 2x4 DRY No.2 SPF C - G 2x4 DRY No.2 SPF G - J 2x4 DRY No.2 SPF J - L 2x4 DRY No.2 SPF V - B 2x6 DRY No.2 SPF M - K 2x6 DRY No.2 SPF S - P 2x6 DRY 1650F 1.5E SPF P - M 2x6 DRY 1650F 1.5E SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT DRY: SEASONED LUMBER. DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS: CHORDS #ROWS SURFACE SPACING (IN) LOAD(PLF) TOP CHORDS: (0.122"x3") SPIRAL NAILS A-C 1 12 SIDE(61.0) C-G 1 12 SIDE(61.0) G-J 1 12 TOP J-L 1 12 TOP V-B 2 12 TOP M-K 2 12 TOP BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS V-S 2 12 SIDE(0.0) S-P 2 12 SIDE(0.0) P-M 2 12 TOP WEBS: (0.122"x3") SPIRAL NAILS 2x3 1 6 NAILS TO BE DRIVEN FROM ONE SIDE ONLY. GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS. TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY. SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP. PLATES (table is in inches) JT TYPE PLATES W LEN Y X B TMWV-p MT20 5.0 8.0 Edge C TTWW-m MT20 5.0 9.0 Edge D TMWV-t MT20 4.0 8.0 E TMWV-w MT20 2.0 4.0 F TMWV-t MT20 4.0 4.0 G TS-t MT20 3.0 6.0 H TMWV-w MT20 2.0 4.0 I TMWV-t MT20 4.0 8.0 J TTWW-m MT20 5.0 8.0 Edge K TMWV-p MT20 5.0 8.0 Edge M BMV1-p MT20 3.0 8.0 N BMWV-W MT20 5.0 8.0 2.50 2.50 O BMWV-W MT20 5.0 8.0 P BS-t MT20 5.0 8.0 Q BMWVW-t MT20 5.0 8.0 R BMWVW-t MT20 5.0 8.0 S BS-t MT20 5.0 8.0 T BMWV-W MT20 5.0 8.0 U BMWV-W MT20 5.0 8.0 2.50 2.50	DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED GROSS REACTION MAXIMUM FACTORED GROSS REACTION INPUT REQD BRG IN-SX JT VERT HORZ DOWN HORZ UPLIFT IN-SX V 4478 0 4478 0 0 5-8 M 3310 0 3310 0 0 5-8 UNFACTORED REACTIONS 1ST CASE MAX/MIN COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL V 3155 2137 0 0 0 0 1017 0 0 0 M 2334 1572 0 0 0 0 762 0 0 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.88 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD (PLF) MAX. UNBRACED LENGTH (FT) WEBS MAX. FACTORED FORCE (LBS) MAX. UNBRACED LENGTH (FT) FR-TO MEMB. FROM TO A-B 0 / 35 -91.8 -91.8 0.07 (1) 10.00 U-C -88 / 55 0.02 (1) B-C -5078 / 0 -91.8 -91.8 0.42 (1) 3.96 C-T 0 / 3494 0.43 (1) C-D -8908 / 0 -91.8 -91.8 0.50 (1) 3.40 T-D -2245 / 0 0.38 (1) D-E -8902 / 0 -91.8 -91.8 0.66 (1) 2.88 D-R 0 / 2613 0.32 (1) E-W -8902 / 0 -91.8 -91.8 0.37 (1) 3.06 R-E -434 / 0 0.07 (1) W-X -8902 / 0 -91.8 -91.8 0.37 (1) 3.06 Q-H -348 / 0 0.06 (1) X-F -8902 / 0 -91.8 -91.8 0.37 (1) 3.06 Q-I 0 / 2738 0.34 (1) F-G -8262 / 0 -91.8 -91.8 0.33 (1) 3.22 O-I -2330 / 0 0.39 (1) G-H -8262 / 0 -91.8 -91.8 0.33 (1) 3.22 Q-J 0 / 3621 0.45 (1) H-I -8262 / 0 -91.8 -91.8 0.61 (1) 3.03 N-J -480 / 0 0.08 (1) I-J -6172 / 0 -91.8 -91.8 0.44 (1) 3.52 B-U 0 / 4292 0.53 (1) J-K -4084 / 0 -91.8 -91.8 0.36 (1) 4.39 N-K 0 / 3453 0.43 (1) K-L 0 / 35 -91.8 -91.8 0.07 (1) 10.00 R-F 0 / 458 0.08 (1) V-B -3981 / 0 0.0 0.0 0.14 (1) 7.12 F-Q -801 / 0 0.48 (1) M-K -3274 / 0 0.0 0.0 0.12 (1) 7.67 V-Y 0 / 0 -18.5 -18.5 0.27 (1) 10.00 Y-Z 0 / 0 -18.5 -18.5 0.27 (1) 10.00 Z-U 0 / 0 -18.5 -18.5 0.27 (1) 10.00 U-T 0 / 4216 -18.5 -18.5 0.29 (1) 10.00 T-S 0 / 6908 -18.5 -18.5 0.44 (1) 10.00 S-AA 0 / 6908 -18.5 -18.5 0.44 (1) 10.00 AA-R 0 / 6908 -18.5 -18.5 0.44 (1) 10.00 R-AB 0 / 8889 -18.5 -18.5 0.84 (1) 10.00 AB-AC 0 / 8889 -18.5 -18.5 0.84 (1) 10.00 AC-AD 0 / 8889 -18.5 -18.5 0.84 (1) 10.00 AD-Q 0 / 8889 -18.5 -18.5 0.84 (1) 10.00 Q-P 0 / 6172 -18.5 -18.5 0.33 (1) 10.00 P-O 0 / 6172 -18.5 -18.5 0.33 (1) 10.00 O-N 0 / 3382 -18.5 -18.5 0.17 (1) 10.00 N-M 0 / 0 -18.5 -18.5 0.02 (4) 10.00 FACTORED CONCENTRATED LOADS (LBS) JT LOC. LC1 MAX. FACE DIR. TYPE C 5-2-7 -44 -49 -- FRONT VERT DEAD -- C1 C 5-2-7 -195 -195 -- FRONT VERT SNOW -- C1 W 15-5-12 -86 -86 -- BACK VERT TOTAL -- C1 X 18-1-12 -86 -86 -- BACK VERT TOTAL -- C1 Y 1-0-12 -17 -17 -- BACK VERT TOTAL -- C1 Z 2-3-8 -915 -915 -- BACK VERT TOTAL -- C1 AA 15-1-8 -915 -915 -- BACK VERT TOTAL -- C1 AB 16-5-12 -17 -17 -- BACK VERT TOTAL -- C1 AC 18-1-12 -17 -17 -- BACK VERT TOTAL -- C1	DESIGN CRITERIA *** SPECIAL LOADS ANALYSIS *** GEOMETRY AND/OR BASIC LOADS CHANGED BY USER. LOADS WERE DERIVED FROM USER INPUT NO FURTHER MODIFICATIONS WERE MADE SPECIFIED LOADS: TOP CH. LL = 25.8 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM *** NON STANDARD GIRDER *** ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES. THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF NBCC 2010, CBC 2012, ABC 2019 - PART 9 OF CBC 2012 (2019 AMENDMENT) - CSA 088-08, CSA 086-14 - TPIC 2011, TPIC 2014 (55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL) = L/360 (1.24") CALCULATED VERT. DEFL.(LL) = L/999 (0.27") ALLOWABLE DEFL.(TL) = L/360 (1.24") CALCULATED VERT. DEFL.(TL) = L/896 (0.50") CSI: TC=0.66/1.00 (D-E:1), BC=0.64/1.00 (Q-R:1), WB=0.53/1.00 (S-U:1), SS=0.32/1.00 (R-T:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00 COMPANION LIVE LOAD FACTOR = 1.00 AUTOSOLVE HEELS OFF TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 788 1987 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP = 0.90 (C) (INPUT = 0.90) JSI METAL = 0.97 (S) (INPUT = 1.00) Structural component only DWG# T-2006385
---	---	---

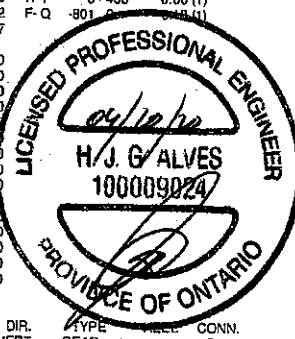

JOB NAME 408204	TRUSS NAME T9Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 07:47:54 2020 Page 2
ID:19ZM6hL14ow3EYgKIUWHCziHzo-TOI F03q176iWDmXOirHzxU ?GD8FEKN1dmYCzPuO.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
V	BMV1+p	MT20	3.0	8.0		


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
AD	18-8-8	-1145	-1145	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

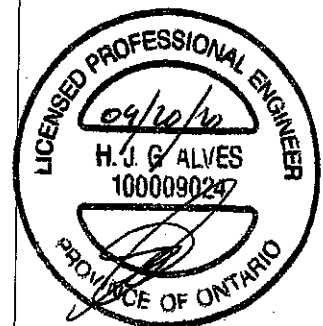

Structural component only
DWG# T-2006385

7/2



TOTAL WEIGHT = 2 X 187 = 375 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC2010, NBC2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF SBCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPGC 2011, TPGC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEF(L) = L/360 (1.24")
CALCULATED VERT. DEF(L) = L/989 (0.15")
ALLOWABLE DEF(T) = L/360 (1.24")
CALCULATED VERT. DEF(T) = L/989 (0.28")

CSI: TC=0.62/1.00 (E-F:1), SC=0.39/1.00 (Q-R:1),
WB=0.80/1.00 (J-M:1), SS=0.24/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVEHEELS OFF

NAIL VALUES		
PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)

	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	798	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.90 (M) (INPUT = 0.90)

JSI METAL = 0.68 (C) (INPUT = 1.00)

1000

1. *Journal of the American Medical Association*, 1997; 278: 1039-1044.


Structural component only
DWG# T-2006386

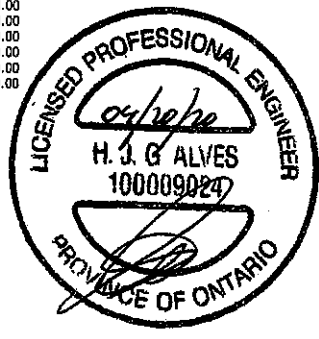

JOB NAME 408204	TRUSS NAME T11	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 07:47:56 2020 Page 1
ID:9ZM6hL4ow3EYgKIUWHCzIHzo-PnmkgO2KM5Nq?pn8epwJMO1uLp1c7N0cl8to4zPuOH
37-2.0 38-5.6
Scale = 1:60.6

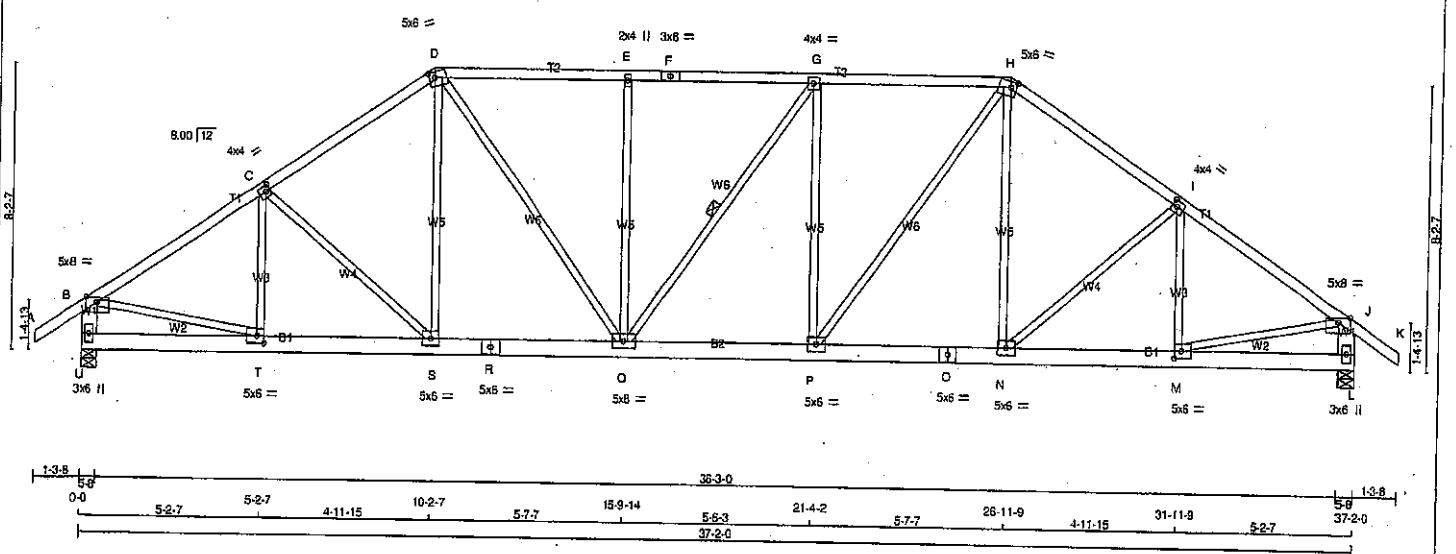

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES					
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - K	2x4	DRY	No.2	SPF	
U - B	2x6	DRY	No.2	SPF	
L - J	2x6	DRY	No.2	SPF	
U - R	2x6	DRY	No.2	SPF	
R - O	2x6	DRY	No.2	SPF	
O - L	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT. TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	5.0	8.0	Edge	
C	TMWW-t	MT20	4.0	4.0	2.00	1.50
D	TTWW-m	MT20	5.0	6.0	2.00	2.00
E	TMWW-w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMWW-t	MT20	4.0	4.0		
H	TTWW-m	MT20	5.0	6.0	2.00	2.00
I	TMWW-t	MT20	4.0	4.0	2.00	1.50
J	TMWW-p	MT20	5.0	8.0	Edge	
L	BMV1-p	MT20	3.0	6.0		
M	BMWW-t	MT20	5.0	6.0	2.50	2.50
N, P, S						
N	BMWW-t	MT20	5.0	6.0		
O	BS-t	MT20	5.0	8.0		
Q	BMWW-t	MT20	5.0	8.0		
R	BS-t	MT20	5.0	8.0		
T	BMWW-t	MT20	5.0	6.0	2.50	2.50
U	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	UPLIFT	IN-SX
U	2175	0	0	5-8
L	2175	0	0	5-8

UNFACTORED REACTIONS	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERMALIVE
U	1536	1021 / 0	0 / 0	0 / 0
L	1536	1021 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-Q.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING	CHORDS	WEBS
TOTAL LOAD CASES: (4)	MAX. FACTORED	MAX. FACTORED
	MEMB. FORCE (LBS)	MEMB. FORCE (LBS)
	FR-TO	FR-TO
	A-B	T-C
	B-C	C-S
	C-D	D-O
	D-E	E-Q
	E-F	F-G
	F-G	G-H
	G-H	H-I
	H-I	I-J
	I-J	J-K
	J-K	K-L
	K-L	L-M
	L-M	M-N
	M-N	N-O
	N-O	O-P
	O-P	P-Q
	P-Q	Q-R
	Q-R	R-S
	R-S	S-T
	S-T	T-U
	T-U	U-V
	U-V	V-W
	V-W	W-X
	W-X	X-Y
	X-Y	Y-Z
	Y-Z	Z-A
	Z-A	A-B

TOTAL WEIGHT = 2 X 192 = 385 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 085-14
- TPIC 2011, TPIC 2014

(55 % OF 21.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.24")
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.24")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSI: TC=0.42/1.00 (G-H:1), BC=0.32/1.00 (P-Q:1), WB=0.68/1.00 (E-Q:1), SS=0.24/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1607 789 1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

SI GRIP= 0.85 (H) (INPUT = 0.90)
SI METAL= 0.53 (M) (INPUT = 1.00)

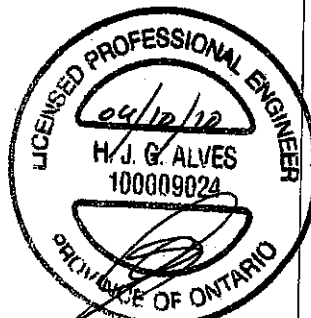

Structural component only
DWG# T-2006387

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408204	T12	2	1	GREEN PARK HOMES	

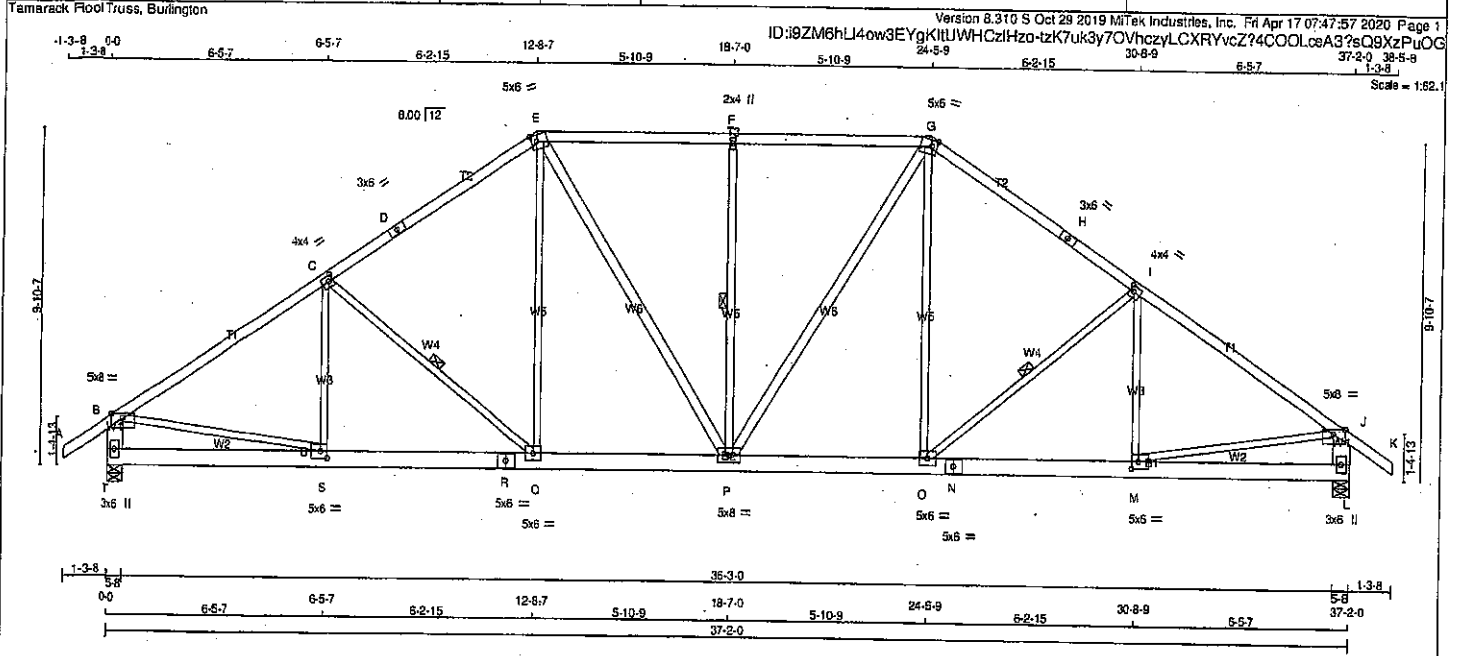

LUMBER				DESIGN CRITERIA			
N. L. G. A. RULES				TOTAL WEIGHT = 2 X 199 = 398 lb			
CHORDS	SIZE	LUMBER	DESCR.	SPECIFIED LOADS:			
A - D	2x4	DRY	No.2	TOP CH.	LL =	25.6	PSF
D - E	2x4	DRY	No.2		DL =	6.0	PSF
E - G	2x4	DRY	No.2	BOT CH.	LL =	0.0	PSF
G - H	2x4	DRY	No.2		DL =	7.4	PSF
H - K	2x4	DRY	No.2	TOTAL LOAD =		38.0	PSF
T - B	2x6	DRY	No.2	SPACING = 24.0 IN. O/C			
L - J	2x6	DRY	No.2	LOADING IN FLAT SECTION BASED ON A SLOPE			
T - R	2x6	DRY	No.2	OF 2.00/12 MINIMUM			
R - N	2x6	DRY	No.2	THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR			
N - L	2x6	DRY	No.2	SMALL BUILDING REQUIREMENTS OF PART 9,			
ALL WEBS	2x3	DRY	No.2	NBC 2010, NBC 2015			
EXCEPT				THIS DESIGN COMPLIES WITH:			
E - P	2x4	DRY	No.2	- PART 9 OF NBC 2018, OBC 2012, ABC 2019			
P - G	2x4	DRY	No.2	- PART 9 OF OBC 2012 (2019 AMENDMENT)			
DRY: SEASONED LUMBER.				- CSA 086-09, CSA 086-14			
				- TPIC 2011, TPIC 2014			

PLATES (table is in inches)				LOADING			
JT TYPE	PLATES	W	LEN Y X	TOTAL LOAD CASES: (4)			
B TMWW-p	MT20	5.0	6.0 Edge	CHORDS			
C TMWW-l	MT20	4.0	4.0 2.00 1.50	MEMB. MAX. FACTORED FORCE (LBS)			
D TS-l	MT20	3.0	6.0	VERT. LOAD LC1 MAX. FACTORED (PLF)			
E TTWW-m	MT20	5.0	6.0 2.25 2.00	FROM TO LENGTH			
F TMWW-w	MT20	2.0	4.0	FR-TO			
G TTWW-m	MT20	5.0	6.0 2.25 2.00	MEMB. MAX. FACTORED FORCE (LBS)			
H TS-l	MT20	3.0	6.0	VERT. LOAD LC1 MAX. FACTORED (PLF)			
I TMWW-l	MT20	4.0	4.0 2.00 1.50	FROM TO LENGTH			
J TMWW-p	MT20	5.0	6.0 Edge	FR-TO			
L BMV1-p	MT20	3.0	6.0	MEMB. MAX. FACTORED FORCE (LBS)			
M BMWW-l	MT20	5.0	6.0 2.50 2.50	VERT. LOAD LC1 MAX. FACTORED (PLF)			
N BS-l	MT20	5.0	6.0	FROM TO LENGTH			
O BMWW-l	MT20	5.0	6.0	FR-TO			
P BMWW-l	MT20	5.0	6.0	MEMB. MAX. FACTORED FORCE (LBS)			
R BS-l	MT20	5.0	6.0	VERT. LOAD LC1 MAX. FACTORED (PLF)			
S BMWW-l	MT20	5.0	6.0 2.50 2.50	FROM TO LENGTH			
T BMV1-p	MT20	3.0	6.0	FR-TO			
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.				MEMB. MAX. FACTORED FORCE (LBS)			

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-Q, F-P, I-O.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L.

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.68 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. O/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.24')

CALCULATED VERT. DEFL.(LL) = L/999 (0.10')

ALLOWABLE DEFL.(TL) = L/360 (1.24')

CALCULATED VERT. DEFL.(TL) = L/999 (0.19')

CSI: TC=0.67/1.00 (I-J:1), BC=0.29/1.00 (M-O:1), WB=0.49/1.00 (J-M:1), SS=0.29/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.83 (M) (INPUT = 0.90)

JSI METAL= 0.54 (M) (INPUT = 1.00)


Structural component only

DWG# T-2006388

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408204	T13	1	1	TRUSS DESC.		

Tamarack Rd Truss, Burlington

Version 2.310 S Oct 29 2019 Mikek Industries, Inc. Fri Apr 17 07:47:58 2020 Page 1
ID:19ZM6hL14ow3EYgKtUWtH0z0-M9uV544auidYE7XXmEynRp6HAcK47qJlfb_hzzPuOf

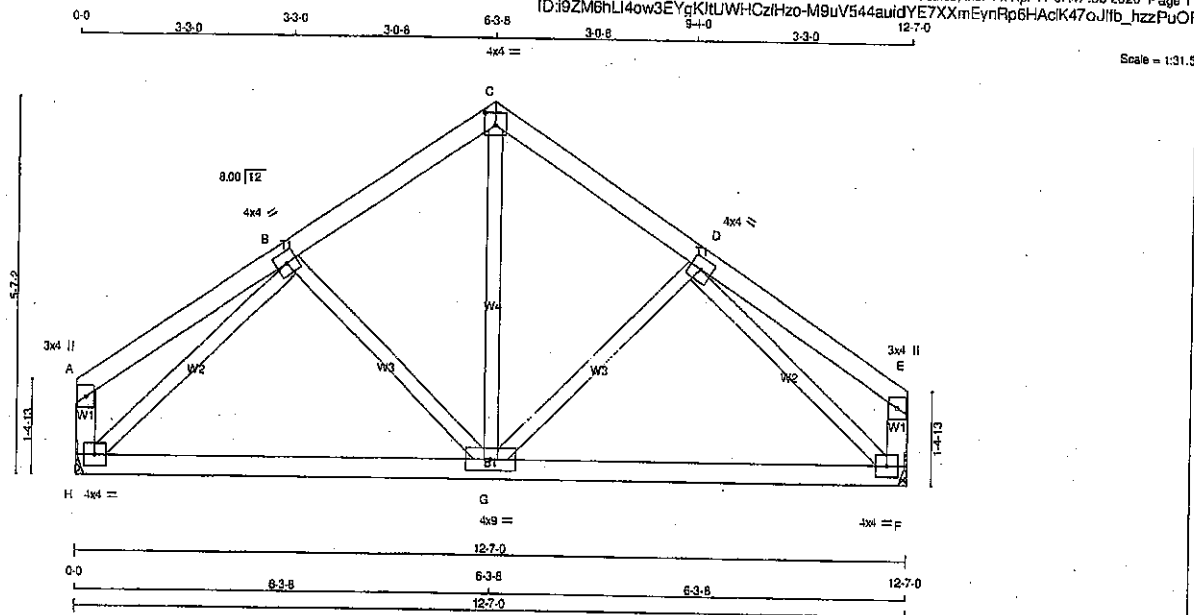

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
A - C	2x4	DRY No.2
C - E	2x4	DRY No.2
H - A	2x4	DRY No.2
F - E	2x4	DRY No.2
H - F	2x4	DRY No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B	TMWW-t	MT20	4.0	4.0		
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TMWW-t	MT20	4.0	4.0		
E	TMV+p	MT20	3.0	4.0		
F	BMVW-t	MT20	4.0	4.0		
G	BMVW-t	MT20	4.0	9.0		
H	BMVW-t	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
H	694	0	694	0
F	694	0	694	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H, F. MINIMUM BEARING LENGTH AT JOINT H = 1-8, JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS
	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
H	491	322 / 0 0 / 0 0 / 0 0 / 0 169 / 0 0 / 0
F	491	322 / 0 0 / 0 0 / 0 0 / 0 169 / 0 0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	W E B S	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 MAX (PLF) CSI (LC) UNBRAC LENGTH FR-TO	MEMB.	FORCE (LBS) MAX CSI (LC)
A-B	0 / 18	-91.8 -91.8 0.14 (1) 10.00	G-C	0 / 347 0.08 (1)
B-C	-534 / 0	-91.8 -91.8 0.11 (1) 6.25	G-D	-144 / 0 0.05 (1)
C-D	-534 / 0	-91.8 -91.8 0.11 (1) 6.25	B-G	-144 / 0 0.05 (1)
D-E	0 / 18	-91.8 -91.8 0.14 (1) 10.00	H-B	-755 / 0 0.24 (1)
H-A	-112 / 0	0.0 0.0 0.01 (1) 7.81	D-F	-755 / 0 0.24 (1)
F-E	-112 / 0	0.0 0.0 0.01 (1) 7.81		
H-G	0 / 531	-18.5 -18.5 0.25 (4) 10.00		
G-F	0 / 531	-18.5 -18.5 0.25 (4) 10.00		

TOTAL WEIGHT = 52 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL = 6.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.42")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.42")
CALCULATED VERT. DEFL. (TL) = L/999 (0.04")

CSI: TC=0.14/1.00 (A-B:1), BC=0.25/1.00 (F-G:4), WB=0.24/1.00 (B-H:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.67 (D) (INPUT = 0.90)
JSI METAL= 0.27 (B) (INPUT = 1.00)

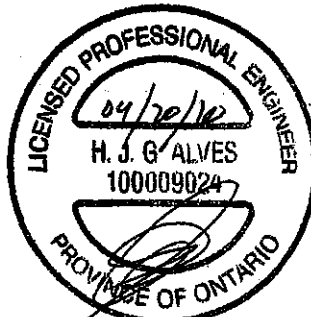

Structural component only
DWG# T-2006389

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408204	T13S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

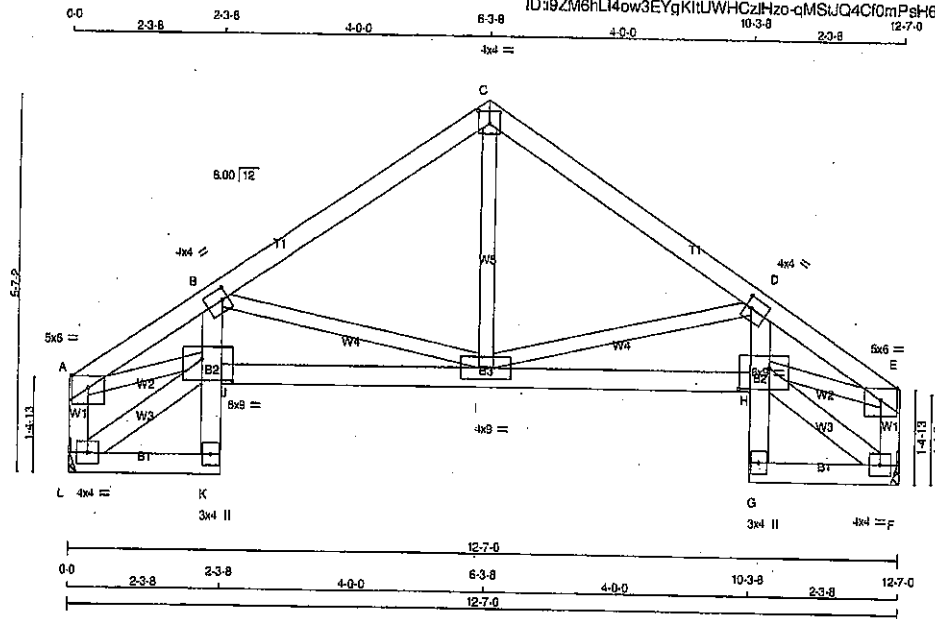

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 07:47:59 2020 Page 1
 ID:9ZM6hL14dw3EYgKltUWHCzIHzo-qMSUQ4Cf0mPsh6jKxT0_1frv04PpZSTXJLXDPzPuOE
 Scale = 1:31.5

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
L - A	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
L - K	2x4	DRY	No.2	SPF
K - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
G - D	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF

ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
L - J	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-p	MT20	5.0	5.0	Edge
B	TMVW-l	MT20	4.0	4.0	2.00 1.00
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TMVW-l	MT20	4.0	4.0	2.00 1.00
E	TMVW-p	MT20	5.0	5.0	Edge
F	BMVW-l	MT20	4.0	4.0	
G	BMVW-p	MT20	3.0	4.0	
H	BMVW-l	MT20	6.0	6.0	3.75 5.50
I	BMVW-l	MT20	4.0	9.0	
J	BMVW-l	MT20	6.0	9.0	3.75 5.50
K	BMVW-p	MT20	3.0	4.0	
L	BMVW-l	MT20	4.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	HORZ	DOWN	HORZ
L	694	0	894
F	684	0	894

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT L. F. MINIMUM BEARING LENGTH AT JOINT L = 1-8, JOINT F = 1-8.

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT COMBINED	SNOW	LIVE
L	491	322 / 0
F	491	322 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.34 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO	FR-TO	FR-TO	FR-TO	FR-TO	FR-TO	FR-TO	FR-TO	FR-TO	FR-TO
A-B	-1434 / 0	-91.8	-91.8	0.12 (1)	5.34	I-C	0 / 418	0.09 (1)	
B-C	-891 / 0	-91.8	-91.8	0.20 (1)	6.25	I-D	-747 / 0	0.23 (1)	
C-D	-891 / 0	-91.8	-91.8	0.20 (1)	6.25	B-I	-747 / 0	0.23 (1)	
D-E	-1434 / 0	-91.8	-91.8	0.12 (1)	5.34	L-J	-58 / 0	0.01 (1)	
L-A	-841 / 0	0.0	0.0	0.07 (1)	7.81	A-J	0 / 1235	0.28 (1)	
F-E	-841 / 0	0.0	0.0	0.07 (1)	7.81	H-F	-58 / 0	0.01 (1)	
						H-E	0 / 1235	0.28 (1)	
L-K	0 / 48	-18.5	-18.5	0.03 (4)	10.00				
K-J	0 / 22	0.0	0.0	0.10 (1)	10.00				
J-B	0 / 280	0.0	0.0	0.14 (1)	10.00				
J-I	0 / 1283	-18.5	-18.5	0.26 (1)	10.00				
I-H	0 / 1283	-18.5	-18.5	0.26 (1)	10.00				
G-H	0 / 22	0.0	0.0	0.10 (1)	10.00				
H-D	0 / 280	0.0	0.0	0.14 (1)	10.00				
G-F	0 / 48	-18.5	-18.5	0.03 (4)	10.00				

TOTAL WEIGHT = 2 X 57 = 114 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.42")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
 ALLOWABLE DEFL.(TL) = L/360 (0.42")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.06")

CSI: TC=0.20/1.00 (C-D:1), BC=0.28/1.00 (H-I:1), WB=0.28/1.00 (E-H:1), SS=0.14/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.61 (B) (INPUT = 0.90)
 JSI METAL= 0.26 (E) (INPUT = 1.00)



Structural component only
 DWG# T-2006390


JOB NAME 408204	TRUSS NAME T14	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version B.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 07:48:00 2020 Page 1

ID:9ZM6hL4ow3EYgKiiUWHCzIHzoFY0FWm5qJUGTRhwtf_FWEbb_QR9Yuxdy45szPuOD

Scale = 1:42.2

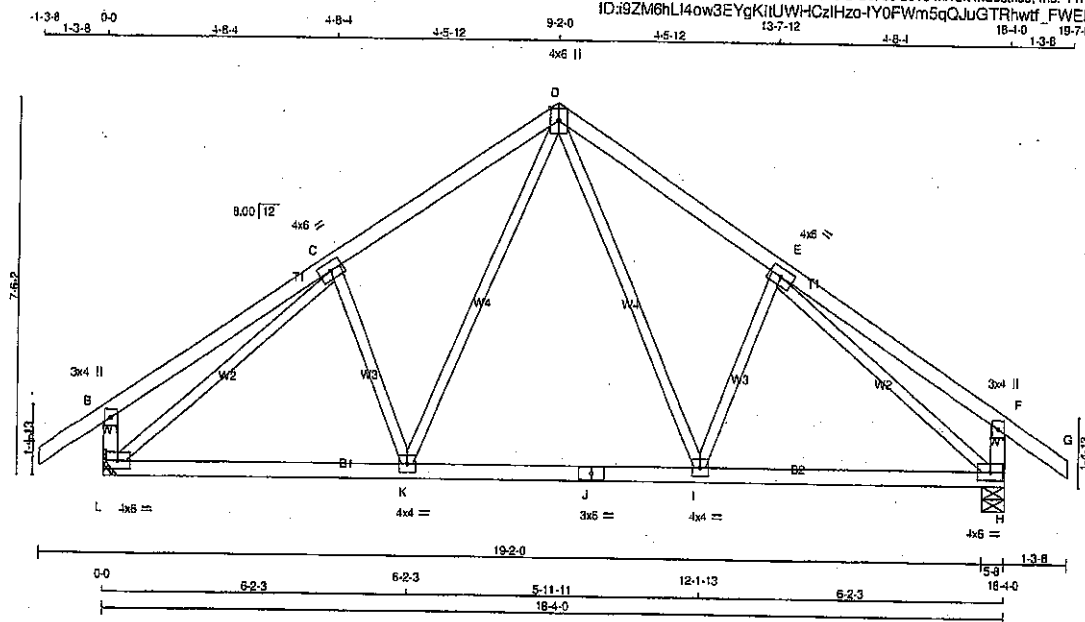

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - G	2x4	DRY No.2	SPF
L - B	2x4	DRY No.2	SPF
H - F	2x4	DRY No.2	SPF
L - J	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
C	TMVW-t	MT20	4.0	6.0	
D	TTWW+p	MT20	4.0	6.0	Edge
E	TMVW-t	MT20	4.0	6.0	
F	TMV+p	MT20	3.0	4.0	
H	BMVW-t	MT20	4.0	6.0	
I	BMVW-t	MT20	4.0	4.0	
J	BS-t	MT20	3.0	6.0	
K	BMVW-t	MT20	4.0	4.0	
L	BMVW-t	MT20	4.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
L	1137	0	1137	0
H	1137	0	1137	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT L. MINIMUM BEARING LENGTH AT JOINT L = 3'-8".

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	801	539 / 0	0 / 0	0 / 0	0 / 0	262 / 0	0 / 0
H	801	539 / 0	0 / 0	0 / 0	0 / 0	262 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED HORIZ. LOAD (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO					
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00
B-C	0 / 27	-91.8	-91.8	0.31 (1)	10.00
C-D	-981 / 0	-91.8	-91.8	0.25 (1)	5.99
D-E	-981 / 0	-91.8	-91.8	0.25 (1)	5.99
E-F	0 / 27	-91.8	-91.8	0.31 (1)	10.00
F-G	0 / 35	-91.8	-91.8	0.12 (1)	10.00
L-B	-288 / 0	0.0	0.0	0.03 (1)	7.81
H-F	-288 / 0	0.0	0.0	0.03 (1)	7.81
L-K	0 / 889	-18.5	-18.5	0.23 (4)	10.00
K-J	0 / 841	-18.5	-18.5	0.21 (4)	10.00
J-I	0 / 841	-18.5	-18.5	0.21 (4)	10.00
I-H	0 / 889	-18.5	-18.5	0.23 (4)	10.00



DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.61")
CALCULATED VERT. DEFL.(LL) = $L/899$ (0.03")
ALLOWABLE DEFL.(TL) = $L/360$ (0.61")
CALCULATED VERT. DEFL.(TL) = $L/899$ (0.06")

CSI: TC=0.31/1.00 (B-C:1), BC=0.23/1.00 (K-L:4), WB=0.77/1.00 (C-L:1), SS=0.17/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX	MIN	MAX
618	354	1667
788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.83 (C) (INPUT = 0.90)
JSI METAL = 0.31 (E) (INPUT = 1.00)

Structural component only
DWG# T-2006391

JOB NAME 408204	TRUSS NAME T14G	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington



Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Fri Apr 17 07:49:01 2020 Page 1
ID:9ZM6hL14ow3EYgKltUWHCzIHzo-mkadj66SAd075bG6RMVU3Skp9qpgHV2m_cqellzPuOC

Scale = 1:42.6

LUMBER

N. L. G. A. RULES
CHORDS SIZE
A - G 2x4 DRY No.2
G - M 2x4 DRY No.2
Y - B 2x4 DRY No.2
N - L 2x4 DRY No.2
Y - R 2x4 DRY No.2
R - N 2x4 DRY No.2

LUMBER
No.2
No.2
No.2
No.2
No.2
No.2

DESCR.
SPF
SPF
SPF
SPF
SPF
SPF

ALL WEBS 2x3 DRY No.2
ALL GABLE WEBS 2x3 DRY No.2
DRY, SEASONED LUMBER.

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.25	2.00
C, D, E, F, H, I, J, K					
C TMVW-w	MT20	2.0	4.0		
G TMVW-p	MT20	4.0	4.0	2.25	2.00
L TMVW+p	MT20	4.0	4.0	1.25	2.00
N BMV1+p	MT20	3.0	4.0		
O BMVW1-i	MT20	4.0	4.0		
P, Q, S, T, U, V, W					
P BMV1-w	MT20	2.0	4.0		
R BS-i	MT20	3.0	6.0		
X BMVW1-i	MT20	4.0	4.0		
Y BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX. (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	LC1 MAX. (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/35	-91.8 -91.8 0.12 (1)	10.00	T-G	-143/0	0.14 (1)	
B-C	-64/0	-91.8 -91.8 0.12 (1)	6.25	U-F	-209/0	0.13 (1)	
C-D	-16/0	-91.8 -91.8 0.05 (1)	6.25	V-E	-173/0	0.06 (1)	
D-E	-18/0	-91.8 -91.8 0.05 (1)	6.25	W-D	-196/0	0.04 (1)	
E-F	-10/0	-91.8 -91.8 0.05 (1)	10.00	X-C	-58/0	0.01 (1)	
F-G	-20/0	-91.8 -91.8 0.05 (1)	6.25	S-H	-209/0	0.13 (1)	
G-H	-20/0	-91.8 -91.8 0.05 (1)	6.25	Q-I	-173/0	0.06 (1)	
H-I	-10/0	-91.8 -91.8 0.05 (1)	10.00	P-J	-196/0	0.04 (1)	
I-J	-18/0	-91.8 -91.8 0.05 (1)	6.25	O-K	-58/0	0.01 (1)	
J-K	-18/0	-91.8 -91.8 0.05 (1)	6.25	B-X	0/29	0.01 (1)	
K-L	-64/0	-91.8 -91.8 0.12 (1)	6.25	O-L	0/29	0.01 (1)	
L-M	0/35	-91.8 -91.8 0.12 (1)	10.00				
Y-B	-289/0	0.0 0.0 0.03 (1)	7.81				
N-L	-289/0	0.0 0.0 0.03 (1)	7.81				
Y-X	0/0	-18.5 -18.5 0.01 (4)	10.00				
X-W	0/19	-18.5 -18.5 0.02 (4)	10.00				
W-V	0/14	-18.5 -18.5 0.02 (4)	10.00				
V-U	0/11	-18.5 -18.5 0.02 (4)	10.00				
U-T	0/8	-18.5 -18.5 0.01 (4)	10.00				
T-S	0/8	-18.5 -18.5 0.01 (4)	10.00				
S-R	0/11	-18.5 -18.5 0.02 (4)	10.00				
R-Q	0/11	-18.5 -18.5 0.02 (4)	10.00				
Q-P	0/14	-18.5 -18.5 0.02 (4)	10.00				
P-O	0/19	-18.5 -18.5 0.02 (4)	10.00				
O-N	0/0	-18.5 -18.5 0.01 (4)	10.00				

TOTAL WEIGHT = 83 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 5.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (W-X:4), WB=0.14/1.00 (G-T:1), SS=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.48 (O) (INPUT = 0.90)
JSI METAL= 0.11 (H) (INPUT = 1.00)

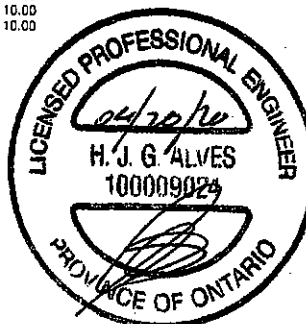


Structural component only
DWG# T-2006392

JOB NAME 408204	TRUSS NAME T15	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 07:48:02 2020 Page 1
ID:9ZM6hLI4ow3EYgKtUWHCzHza-Ew70xS74xx8_jkl741jclGy1D8i0_ZvDGZBqkzPuOB

Scale = 1:25.6

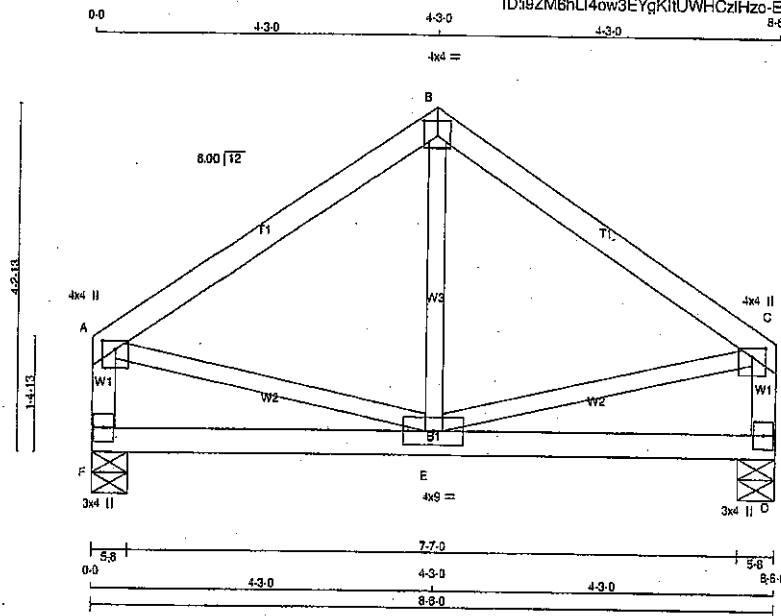

TOTAL WEIGHT = 33 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
F - A	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TTW+p	MT20	4.0	4.0	2.25	2.00
C	TMVW+p	MT20	4.0	4.0	1.25	2.00
D	BMV1+p	MT20	3.0	4.0		
E	BMVWW+1	MT20	4.0	9.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT VERT	HORZ	DOWN	HORZ
F	469	0	469
D	469	0	469

UNFACTORED REACTIONS

1ST CASE	MAX	MIN	COMPONENT	REACTIONS
JT	COMBINED	SNOW	LIVE	PERM.LIVE
F	331	217.0	0.0	0.0
D	331	217.0	0.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. VERT. LOAD (LC1)	MAX. CSI (LC)	UNBRACED LENGTH FR-TO	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO						MEMB.		
A-B	-317.0	-91.8	-91.8	0.21 (1)	6.25	E-B	-39.59	0.02 (4)
B-C	-317.0	-91.8	-91.8	0.21 (1)	6.25	A-E	0.272	0.06 (1)
F-A	-438.0	0.0	0.0	0.05 (1)	7.81	E-C	0.272	0.06 (1)
D-C	-438.0	0.0	0.0	0.05 (1)	7.81			
F-E	0.0	-18.5	-18.5	0.09 (4)	10.00			
E-D	0.0	-18.5	-18.5	0.09 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28')
CALCULATED VERT. DEFL.(LL) = L/999 (0.00')
ALLOWABLE DEFL.(TL) = L/360 (0.28')
CALCULATED VERT. DEFL.(TL) = L/999 (0.01')

CSI: TC=0.21/1.00 (A-B:1), BC=0.09/1.00 (E-F:4), WB=0.06/1.00 (C-E:1), SS=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.34 (C) (INPUT = 0.30)
JSI METAL= 0.10 (C) (INPUT = 1.00)

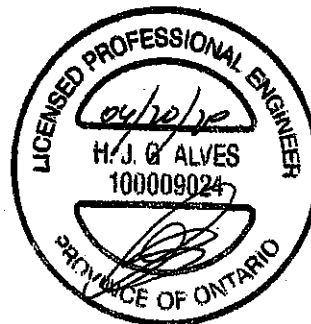


Structural component only
DWG# T-2006393

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408204	T15G	1	1	TRUSS DESC.		

Tamarack Rod Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 07:48:03 2020 Page 1
ID:9ZM6hLi4ow3EYgKtIUWHCziHzo-7hO8o7jEGrKuPVZnYy8tp9AdV2IR72RwJlMBzPuOA

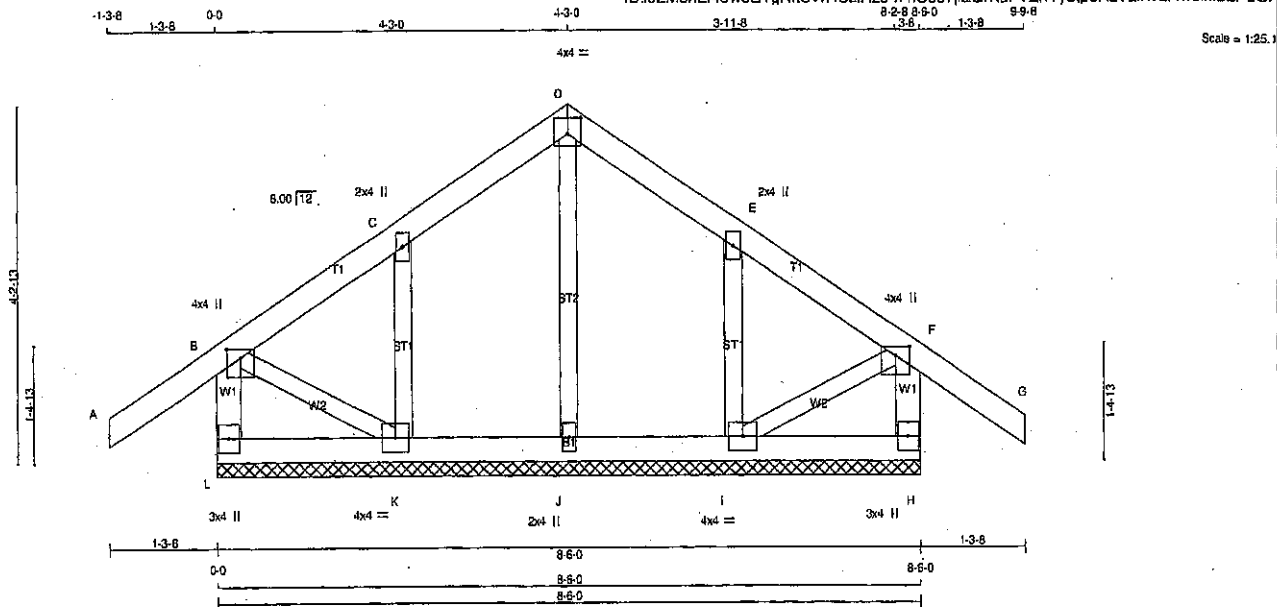

TOTAL WEIGHT = 38 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
L - B	2x4	DRY
A - D	2x4	DRY
D - G	2x4	DRY
H - F	2x4	DRY
L - H	2x4	DRY

ALL WEBS 2x3 DRY No.2
ALL GABLE WEBS 2x3 DRY No.2
DRY, SEASONED LUMBER.

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TMVW+w	MT20	2.0	4.0		
D	TTW-p	MT20	4.0	4.0	2.25	2.00
E	TMVW+w	MT20	2.0	4.0		
F	TMVW+p	MT20	4.0	4.0	1.25	2.00
H	BMV1+p	MT20	3.0	4.0		
I	BMVW1-l	MT20	4.0	4.0		
J	BMV1+w	MT20	2.0	4.0		
K	BMVW1-l	MT20	4.0	4.0		
L	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	CHORDS		MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	WEBS		MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
		VERT. LOAD	PLF	VERT. LOAD	PLF	FR-TO	UNBRAC	FR-TO	UNBRAC
L-B	-222 / 0	0.0	0.0	0.02 (1)	7.81	J-D	-129 / 0	0.03 (1)	0.04 (1)
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	K-C	-237 / 0	0.04 (1)	0.04 (1)
B-C	-8 / 0	-91.8	-91.8	0.07 (1)	10.00	I-E	0 / 19	0.00 (1)	0.00 (1)
C-D	-25 / 0	-91.8	-91.8	0.07 (1)	6.25	B-K	0 / 19	0.00 (1)	0.00 (1)
D-E	-25 / 0	-91.8	-91.8	0.07 (1)	6.25	I-F	0 / 19	0.00 (1)	0.00 (1)
E-F	-8 / 0	-91.8	-91.8	0.07 (1)	10.00				
F-G	0 / 35	-91.8	-91.8	0.12 (1)	10.00				
H-F	-222 / 0	0.0	0.0	0.02 (1)	7.81				
L-K	0 / 0	-18.5	-18.5	0.02 (4)	10.00				
K-J	0 / 10	-18.5	-18.5	0.02 (4)	10.00				
J-I	0 / 10	-18.5	-18.5	0.02 (4)	10.00				
I-H	0 / 0	-18.5	-18.5	0.02 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
DL =	6.0	PSF	
BOT CH.	LL =	0.0	PSF
DL =	7.4	PSF	
TOTAL LOAD =	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS: TC=0.12/1.00 (F-G:1), BC=0.02/1.00 (J-K:4), WB=0.04/1.00 (C-K:1), SS=0.08/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	518 354	1987 788

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.16 (E) (INPUT = 0.90)

JSI METAL= 0.12 (E) (INPUT = 1.00)

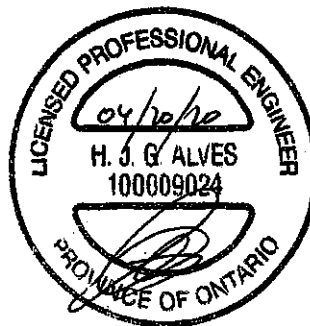

Structural component only
DWG# T-2006394

LUMBER		DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER		TOTAL WEIGHT = 2 X 178 = 352 lb	
N.L.G.A. RULES		BEARINGS		DESIGN CRITERIA	
CHORDS	SIZE	LUMBER	DESCR.	*** SPECIAL LOADS ANALYSIS ***	
A - C	2x4	DRY	No.2	GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.	
C - G	2x4	DRY	No.2	LOADS WERE DERIVED FROM USER INPUT	
G - J	2x4	DRY	No.2	NO FURTHER MODIFICATIONS WERE MADE	
J - L	2x4	DRY	No.2	SPECIFIED LOADS:	
V - B	2x6	DRY	No.2	TOP CH. LL = 25.6 PSF	
M - K	2x6	DRY	No.2	DL = 6.0 PSF	
V - S	2x6	DRY	No.2	BOT CH. LL = 6.0 PSF	
S - P	2x6	DRY	No.2	DL = 7.4 PSF	
P - M	2x6	DRY	No.2	TOTAL LOAD = 39.0 PSF	
ALL WEBS	2x3	DRY	No.2	SPACING = 24.0 IN.C/C	
EXCEPT				LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM	
DRY, SEASONED LUMBER.		BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M		*** NON STANDARD GIRDER ***	
DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:		BRACING		ADDTL. USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.	
CHORDS #ROWS		LOADING		THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015	
SURFACE SPACING (IN)		TOTAL LOAD CASES: (4)		THIS DESIGN COMPLIES WITH:	
TOP CHORDS: (0.122"x3") SPIRAL NAILS		CHORDS		- PART 9 OF BOBC 2018, OBC 2012, ABC 2019	
A-C	1	12	TOP	- PART 9 OF OBC 2012 (2019 AMENDMENT)	
C-G	1	12	TOP	- CSA 085-09, CSA 085-14	
G-J	1	12	SIDE(61.0)	- TPIC 2011, TPIC 2014	
J-L	1	12	SIDE(61.0)	55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD	
V-B	2	12	TOP	ALLOWABLE DEFL.(LL)= L/360 (1.24")	
M-K	2	12	TOP	CALCULATED VERT. DEFL.(LL)= L/999 (0.15")	
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		WEBS		ALLOWABLE DEFL.(TL)= L/360 (1.24")	
V-S	2	12	TOP	CALCULATED VERT. DEFL.(TL)= L/999 (0.28")	
S-P	2	12	TOP	CS1: TC=0.37*1.00 (H-H1), BC=0.37*1.00 (Q-R1), WB=0.44*1.00 (K-N1), SS1=0.12*1.00 (D-E:1)	
P-M	2	12	SIDE(183.1)	DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00	
WEBS: (0.122"x3") SPIRAL NAILS		NAILS TO BE DRIVEN FROM ONE SIDE ONLY.		COMPANION LIVE LOAD FACTOR = 1.00	
N-J	1	6	SIDE(132.7)	AUTOSOLVE HEELS OFF	
2x3	1	6		TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.	
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.		SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.		NAIL VALUES	
TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.		PLATES (table is in inches)		PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)	
SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.		JT TYPE PLATES W LEN Y X		MT20 618 354 1667 788 1987 1656	
PLATES (table is in inches)		JT TYPE PLATES W LEN Y X		PLATE PLACEMENT TOL = 0.250 inches	
B TMWV-p	MT20	5.0	6.0	1.50	3.00
C TTWW-m	MT20	5.0	8.0	2.00	3.25
D, F, I					
D TMWV-i	MT20	4.0	4.0		
E TMW-w	MT20	2.0	4.0		
G TS-i	MT20	3.0	6.0		
H TMW-w	MT20	2.0	4.0		
J TTWW-m	MT20	5.0	8.0	2.00	3.25
K TMWV-p	MT20	5.0	6.0	1.50	3.00
M BMV1+p	MT20	3.0	6.0		
N, O, T, U					
N BMWV-i	MT20	5.0	6.0		
P BS-i	MT20	5.0	6.0		
Q BMWVW-i	MT20	5.0	8.0		
R BMWVW-i	MT20	5.0	8.0		
S BS-i	MT20	5.0	6.0		

TOTAL WEIGHT = 2 X 176 = 352 LBS
 BUILDING DESIGNER
 BEARINGS
 FACTORED MAXIMUM FACTORED INPUT REGRD
 GROSS REACTION GROSS REACTION BRG BRG
 VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX
 V 4111 0 4111 0 0 5-6 5-6
 M 2792 0 2792 0 0 5-6 5-6

UNFACTORED REACTIONS
 1ST LCASE MAX/MIN COMPONENT REACTIONS
 V COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL
 J 2900 1941 / 0 0 / 0 0 0 959 0 0 0
 M 1970 1317 / 0 0 / 0 0 0 653 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M
 BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.33 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)
 CHORDS MAX. FACTORED FACTORED WEBS MAX. FACTORED
 MEMB. FORCE VERT. LOAD LC1 MAX MAX. MEMB. FORCE MAX
 (LBS) (PLF) CSI (LC) LENGTH FR-TO (LBS) CSI (LC)
 FR-TO FROM TO
 A-B 0 / 35 -91.8 -91.8 0.07 (1) 10.00 U-C -822.0 0.11 (1)
 B-C -5175 / 0 -91.8 -91.8 0.43 (1) 3.92 C-T 0 / 3885 0.48 (1)
 C-W -7089 / 0 -91.8 -91.8 0.48 (1) 3.33 T-D -657 / 0 0.11 (1)
 W-X -7089 / 0 -91.8 -91.8 0.48 (1) 3.33 O-I -1766 / 0 0.39 (1)
 X-D -7089 / 0 -91.8 -91.8 0.48 (1) 3.33 O-J 0 / 2700 0.39 (1)
 D-E -7113 / 0 -91.8 -91.8 0.56 (1) 3.33 N-J -421 / 0 0.07 (1)
 E-F -7113 / 0 -91.8 -91.8 0.31 (1) 3.46 B-U 0 / 4375 0.54 (1)
 F-G -6307 / 0 -91.8 -91.8 0.28 (1) 3.69 N-K 0 / 2828 0.35 (1)
 G-H -8307 / 0 -91.8 -91.8 0.28 (1) 3.69 O-I 0 / 2009 0.25 (1)
 H-I -8307 / 0 -91.8 -91.8 0.46 (1) 3.59 D-R 0 / 44 0.01 (4)
 I-J -4719 / 0 -91.8 -91.8 0.31 (1) 4.16 C-H -439 / 0 0.07 (1)
 J-K -3345 / 0 -91.8 -91.8 0.32 (1) 4.79 R-E -427 / 0 0.07 (1)
 K-L 0 / 35 -91.8 -91.8 0.07 (1) 10.00 R-F 0 / 648 0.08 (1)
 V-B -4051 / 0 0.0 0.0 1.14 (1) 7.06 F-Q -838 / 0 0.08 (1)
 M-K -2748 / 0 0.0 0.0 0.10 (1) 7.81

V-Y 0 0 -18.5 -18.5 0.04 (4) 10.00
 Y-Z 0 0 -18.5 -18.5 0.04 (4) 10.00
 Z-U 0 / 0 -18.5 -18.5 0.04 (4) 10.00
 U-AA 0 / 4286 -18.5 -18.5 0.33 (1) 10.00
 AA-AB 0 / 4286 -18.5 -18.5 0.33 (1) 10.00
 AB-T 0 / 4286 -18.5 -18.5 0.33 (1) 10.00
 T-S 0 / 7089 -18.5 -18.5 0.52 (1) 10.00
 S-R 0 / 7089 -18.5 -18.5 0.52 (1) 10.00
 R-Q 0 / 6762 -18.5 -18.5 0.48 (1) 10.00
 Q-P 0 / 4719 -18.5 -18.5 0.35 (1) 10.00
 P-O 0 / 4719 -18.5 -18.5 0.35 (1) 10.00
 O-N 0 / 2770 -18.5 -18.5 0.19 (1) 10.00
 N-M 0 / 0 -18.5 -18.5 0.03 (4) 10.00

FACTORED CONCENTRATED LOADS (LBS)
 JT LOC. LC1 MAX. MAX+ FACE DIR.
 C 5-2-7 -44 -49 --- FRONT VERT DEAD TOTAL --- C1
 C 5-2-7 -92 -92 --- BACK VERT DEAD TOTAL --- C1
 C 5-2-7 -185 -185 --- FRONT VERT SNOW TOTAL --- C1
 T 9-10-8 -1963 -1963 --- BACK VERT TOTAL --- C1
 U 5-0-12 -17 -17 --- BACK VERT TOTAL --- C1
 W 7-0-12 -86 -86 --- BACK VERT TOTAL --- C1
 X 9-0-12 -86 -86 --- BACK VERT TOTAL --- C1
 Y 1-0-12 -17 -17 --- BACK VERT TOTAL --- C1
 Z 3-0-12 -17 -17 --- BACK VERT TOTAL --- C1
 AA 7-0-12 -17 -17 --- BACK VERT TOTAL --- C1
 AB 9-0-12 -17 -17 --- BACK VERT TOTAL --- C1

DESIGN CRITERIA
 *** SPECIAL LOADS ANALYSIS ***
 GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
 LOADS WERE DERIVED FROM USER INPUT
 NO FURTHER MODIFICATIONS WERE MADE
 SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF
 SPACING = 24.0 IN. CC
 LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM
 *** NON STANDARD GIRDER ***
 ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.
 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC0 2010, NBC0 2015
 THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC0 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-08, CSA 086-14
 - TPIC 2011, TPIC 2014
 (55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD
 ALLOWABLE DEFL.(LL) = L/360 (1.24")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.20")
 ALLOWABLE DEFL.(TL) = L/360 (1.24")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.38")
 CSI: TC=0.56, 1.00 (D-E-I), 1.60=0.52, 1.00 (R-T-I),
 WB=0.54, 1.00 (B-U), SSL=0.81, 1.00 (C-D-I)
 DOL LUMBER=1.00 NAIL=1.00 L.S. BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00
 COMPANION LIVE LOAD FACTOR = 1.00
 AUTOSOLVE HEELS OFF
 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
 NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 518 354 1667 788 1987 1956
 PLATE PLACEMENT TOL. = 0.250 inches
 PLATE ROTATION TOL. = 5.0 Deg.
 JSI GRIP= 0.89 (O) (INPUT = 0.90)
 JSI METAL= 0.65 (S) (INPUT = 1.00)
 Structural component only
 DWG# T-2006399

LICENSED PROFESSIONAL ENGINEER
 H.J. G'ALVES
 100009024
 PROVIDENCE, ONTARIO

JOB NAME 408205	TRUSS NAME T21Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 07:52:09 2020 Page 2
ID:9ZM6hLI4ow3EYgKIiUWHCziHzo-VSZOnv60ngFxriDmzSye6i?5JokS0aCG0Cvm?wzPuKK


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
U	BMWV-H	MT20	5.0	6.0	2.50	2.50
V	BMWV+P	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.


CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

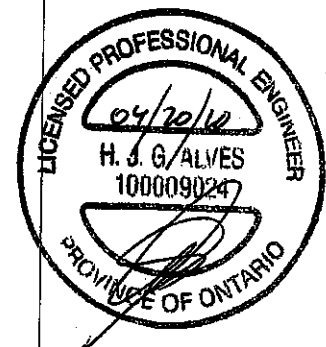

Structural component only
DWG# T-2006399

72

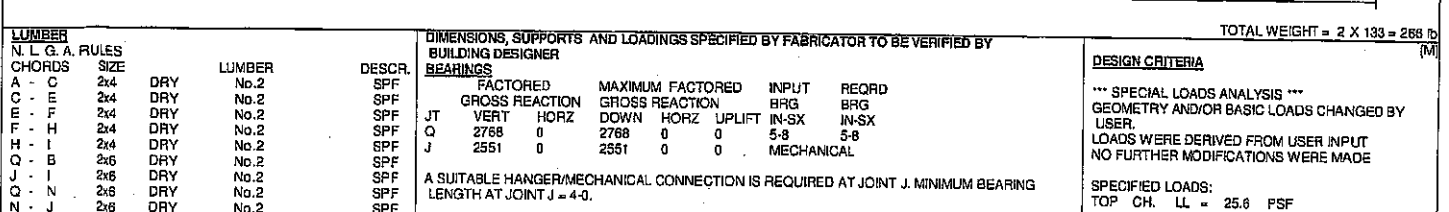[illegible]

CHORDS #HOWS	SURFACE SPACING (IN)	LOAD (PLF)	BRACING	WEBS
TOP CHORDS : (0.122"x3") SPIRAL NAILS			TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.40 FT.	MAX. FACTORED
A-C 1 12		SIDE (61.0)	MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.	MEMB. FORCE MAX
C-E 1 12		SIDE (61.0)		(LBS) CS1 (LC)
E-F 1 12		TOP	ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.	FR-TO
F-H 1 12		SIDE (61.0)		FROM TO LENGTH
H-I 1 12		SIDE (61.0)		FR-TO
Q-B 2 12		TOP		MEMB. FORCE MAX
J-I 2 12		TOP		(LBS) CS1 (LC)
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS			LOAD CASES: (4)	
Q-N 2 12		SIDE (183.1)		
N-J 2 12		SIDE (183.1)		
WEBS : (0.122"x3") SPIRAL NAILS				
2x3 1 8				

[illegible]

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408205	T22	1	2	TRUSS DESC.		


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 07:52:11 2020 Page 2
ID:19ZM6hL4ow3EYgKILUWHCzIHzo-Rqg8Bb7HirWf5?N94t 6BA5Umb2HsXoZTWO13pzPuKl

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
H	22-7-1	-29	-32	---	FRONT	VERT	DEAD	---	C1
H	22-7-1	-147	-147	---	FRONT	VERT	SNOW	---	C1
L	18-1-12	-13	-13	---	FRONT	VERT	TOTAL	---	C1
O	9-11-8	-620	-620	---	FRONT	VERT	TOTAL	---	C1
R	5-0-12	-124	-124	---	FRONT	VERT	TOTAL	---	C1
S	7-0-12	-94	-94	---	FRONT	VERT	TOTAL	---	C1
T	9-0-12	-94	-94	---	FRONT	VERT	TOTAL	---	C1
U	20-1-4	-63	-63	---	TOP	VERT	TOTAL	---	C1
V	22-1-4	-87	-87	---	TOP	VERT	TOTAL	---	C1
W	1-0-12	-19	-19	---	FRONT	VERT	TOTAL	---	C1
X	3-0-12	-19	-19	---	FRONT	VERT	TOTAL	---	C1
Y	5-0-12	-19	-19	---	FRONT	VERT	TOTAL	---	C1
Z	7-0-12	-19	-19	---	FRONT	VERT	TOTAL	---	C1
AA	9-0-12	-19	-19	---	FRONT	VERT	TOTAL	---	C1
AB	18-5-8	-461	-461	---	FRONT	VERT	TOTAL	---	C1
AC	20-1-4	-13	-13	---	FRONT	VERT	TOTAL	---	C1
AD	22-1-4	-13	-13	---	FRONT	VERT	TOTAL	---	C1
AE	24-1-4	-13	-13	---	FRONT	VERT	TOTAL	---	C1
AF	26-1-4	-13	-13	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

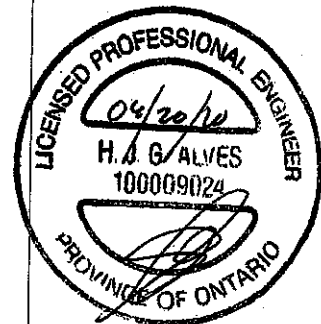


Structural component only
DWG# T-2006400

72

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408205	T24	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 07:52:12 2020 Page 1

ID:19ZM6hL14ow3EYgKlUWHCzIHzo-w1EWPx8v3leWlSyLeaWLkNdhf?TSb1_iiA7CbFzPuKH

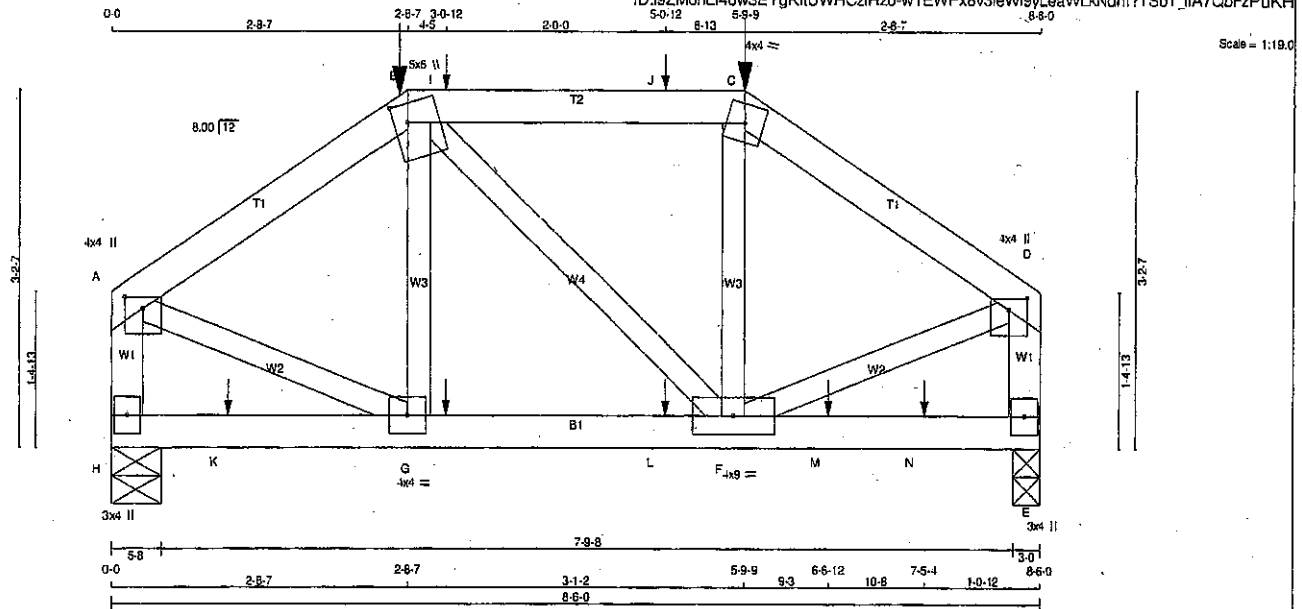

TOTAL WEIGHT = 35 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF
B - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
H - A	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
H - E	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TTWW+m	MT20	5.0	5.0	2.00	1.50
C	TTW-m	MT20	4.0	4.0		
D	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMV1+p	MT20	3.0	4.0		
F	BMWW-I	MT20	4.0	9.0		
G	BMWW-I	MT20	4.0	4.0		
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	DOWN	IN-SX	IN-SX
H	512	0	5-8	5-8
E	512	0	3-0	3-0

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	361	242 / 0	0 / 0	0 / 0	0 / 0	0 / 0	119 / 0	0 / 0
E	361	242 / 0	0 / 0	0 / 0	0 / 0	0 / 0	119 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (7)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. (PLF)	MAX. LC1 (LC)	MAX. UNBRACED LENGTH (FT)	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)
FR-TO						FR-TO			
A-B	-417 / 0	-91.8	-91.8	0.13 (1)	6.25	G-H	-76 / 21	0.02 (1)	
B-I	-343 / 0	-91.8	-91.8	0.17 (1)	6.25	B-F	0 / 6	0.00 (5)	
I-J	-343 / 0	-91.8	-91.8	0.17 (1)	6.25	F-C	-77 / 21	0.02 (1)	
J-C	-343 / 0	-91.8	-91.8	0.17 (1)	6.25	F-D	0 / 371	0.09 (1)	
C-D	-417 / 0	-91.8	-91.8	0.13 (1)	6.25	A-G	0 / 371	0.09 (1)	
H-A	-490 / 0	0.0	0.0	0.08 (1)	7.81				
E-D	-490 / 0	0.0	0.0	0.08 (1)	7.81				
H-K	0 / 0	-18.5	-18.5	0.03 (4)	10.00				
K-G	0 / 0	-18.5	-18.5	0.03 (4)	10.00				
G-L	0 / 344	-18.5	-18.5	0.09 (1)	10.00				
L-F	0 / 344	-18.5	-18.5	0.09 (1)	10.00				
F-M	0 / 0	-18.5	-18.5	0.04 (4)	10.00				
M-N	0 / 0	-18.5	-18.5	0.04 (4)	10.00				
N-E	0 / 0	-18.5	-18.5	0.04 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
B	2-8-7	-8	-7	---	FRONT	VERT	DEAD	---	C1
B	2-8-7	-38	-38	---	FRONT	VERT	SNOW	---	C1
C	5-9-9	-6	-7	---	FRONT	VERT	DEAD	---	C1
C	5-9-9	-38	-38	---	FRONT	VERT	SNOW	---	C1
G	3-0-12	1	1	---	BACK	VERT	TOTAL	---	C1
I	3-0-12	1	1	91	BACK	VERT	TOTAL	---	C1
J	5-0-12	1	1	106	BACK	VERT	TOTAL	---	C1
K	1-0-12	1	1	---	BACK	VERT	TOTAL	---	C1
L	5-0-12	1	1	---	BACK	VERT	TOTAL	---	C1
M	6-6-12	1	1	---	BACK	VERT	TOTAL	---	C1
N	7-5-4	1	1	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***

GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***

ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, CBC 2012, ABC 2019.
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.28")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.17 / 1.00 (B-C:1), BC=0.08 / 1.00 (F-G:1),
WB=0.09 / 1.00 (A-G:1), SSI=0.12 / 1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES


PLATE GRIP(DRY)	SHEAR (FS)	SECTION (PL)
MT20	618	354
	1667	768
	1967	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.43 (G) (INPUT = 0.90)
JSI METAL = 0.13 (G) (INPUT = 1.00)

Structural component only
DWG# T-2006401

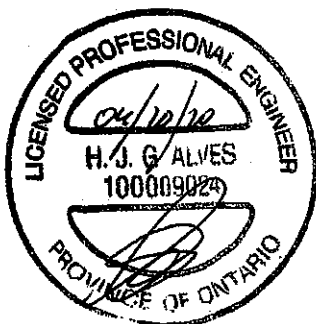


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408205	T25A	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 07:52:13 2020 Page 1
ID:9ZM6hLI4ow3EYgKtUWHCzHHz-ODovcH9Xq2mMkJWYCI1aHbArPpUKVkrxqtz8hzPuKG

Scale = 1:32.5

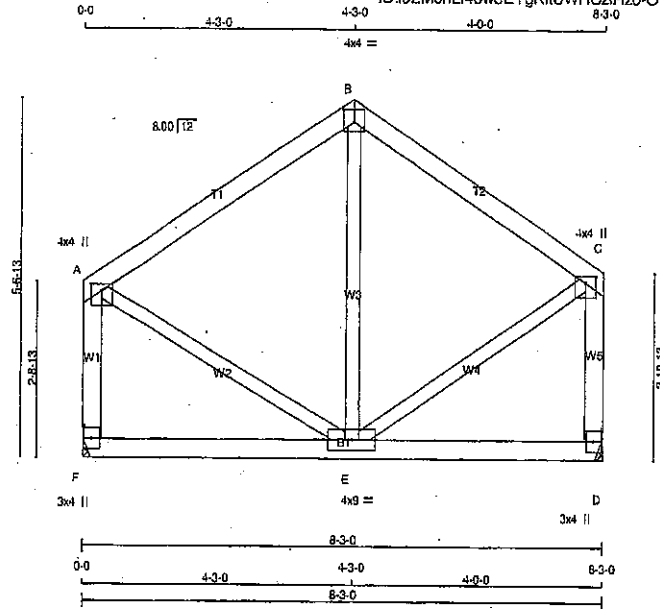

TOTAL WEIGHT = 38 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
F - A	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TTW+p	MT20	4.0	4.0	2.25	2.00
C	TMVW+p	MT20	4.0	4.0	1.25	2.00
D	BMV1+p	MT20	3.0	4.0		
E	BMVWW-1	MT20	4.0	9.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
F	455 0	455 0	MECHANICAL	
D	455 0	455 0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D. MINIMUM BEARING LENGTH AT JOINT F = 1-8, JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS
F	322	211 / 0 0 / 0 0 / 0 111 / 0 0 / 0
D	322	211 / 0 0 / 0 0 / 0 111 / 0 0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO									
A-B	-223 / 0	-91.8	-91.8	0.21 (1)	6.25	E-B	-131 / 23	0.05 (1)	
B-C	-223 / 0	-91.8	-91.8	0.19 (1)	6.25	A-E	0 / 213	0.05 (1)	
F-A	-424 / 0	0.0	0.0	0.06 (1)	7.81	E-C	0 / 221	0.05 (1)	
D-C	-427 / 0	0.0	0.0	0.07 (1)	7.81				
F-E	0 / 0	-18.5	-18.5	0.09 (4)	10.00				
E-D	0 / 0	-18.5	-18.5	0.09 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.28")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.21/1.00 (A-B:1), BC=0.09/1.00 (E-F:4),
WB=0.09/1.00 (9-E:1), SS=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MT20	618	354	1897

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.30 (C) (INPUT = 0.90)
JSI METAL = 0.09 (C) (INPUT = 1.00)

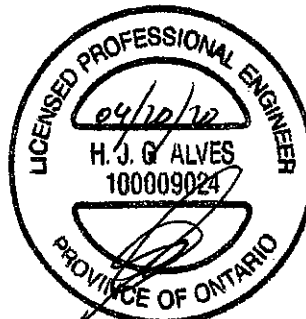


Structural component only
DWG# T-2006402

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408205	T26	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 07:52:14 2020 Page 1
ID:9ZM6HL4ow3EYgKItUWHCziHzo-sPMHqA9bMuDyT5km?Yppoi_dp6g3yv79UcXg7zPuKf

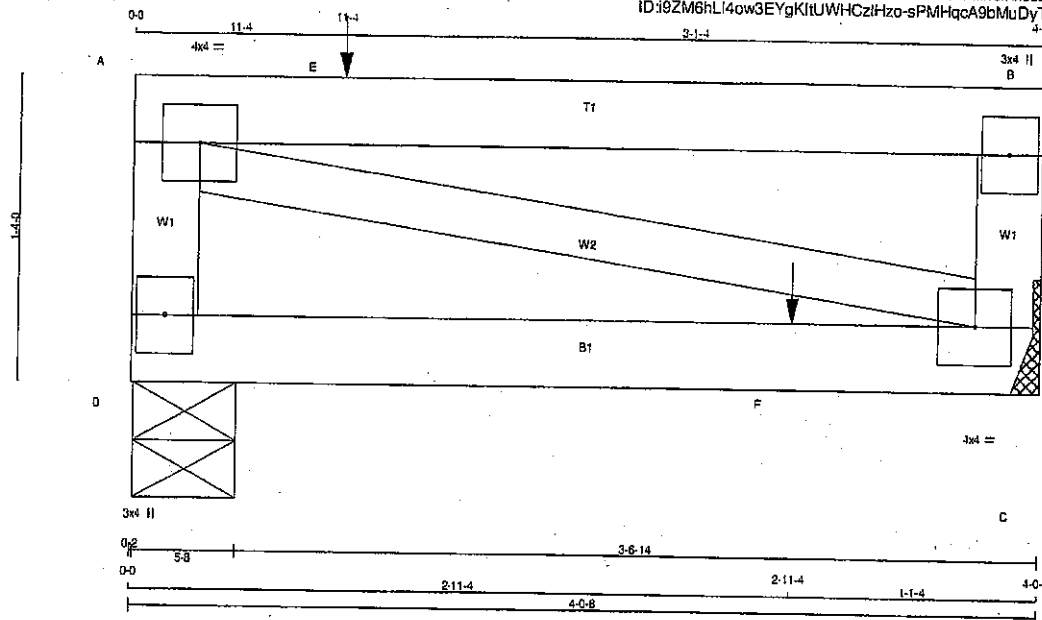

TOTAL WEIGHT = 2 X 14 = 28 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
D - A	2x4	DRY	No.2
A - B	2x4	DRY	No.2
C - B	2x4	DRY	No.2
D - C	2x4	DRY	No.2

ALL WEBS 2x3 DRY
DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
D - A 1	12	TOP
A - B 1	12	TOP
B - C 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
D - C 1	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
A TMW-1	MT20	4.0	4.0		
B TMV+p	MT20	3.0	4.0		
C BMW1-1	MT20	4.0	4.0		
D BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
D	887	887	0	5-8
C	638	638	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT C. MINIMUM BEARING LENGTH AT JOINT C = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX/MIN SNOW	MAX/MIN LIVE	MAX/MIN PERM. LIVE	WIND	DEAD	SOIL
D	472	309/0	0/0	0/0	0/0	163/0	0/0
C	450	302/0	0/0	0/0	0/0	149/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LOAD LC1	MAX. UNBRACED LENGTH	WEBS	MAX. FACTORED MEMB. FORCE (LBS)	MAX. LOAD LC1
D-A	-511/0	0.0	0.0	0.03 (1)	7.81	0/0	0.00 (1)
A-E	0/0	-91.8	-91.8	0.33 (1)	10.00		
E-B	0/0	-91.8	-91.8	0.33 (1)	10.00		
C-B	-284/0	0.0	0.0	0.02 (1)	7.81		
D-F	0/0	-18.5	-18.5	0.28 (1)	10.00		
F-C	0/0	-18.5	-18.5	0.28 (1)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	11-4	-423	-423	---	TOP	VERT	TOTAL	---	C1
F	2-11-4	-436	-436	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/969 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/944 (0.05")
CSI: TC=0.33/1.00 (A-B:1), BC=0.28/1.00 (C-D:1), WB=0.00/1.00 (A-C:1), SS=0.22/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1067 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.15 (A) (INPUT = 0.90)
JSI METAL = 0.04 (A) (INPUT = 1.00)

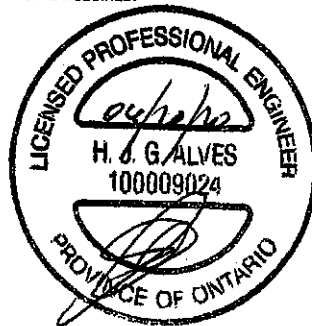


Structural component only
DWG# T-2006403

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408205	T27	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mirak Industries, Inc. Fri Apr 17 07:52:15 2020 Page 1

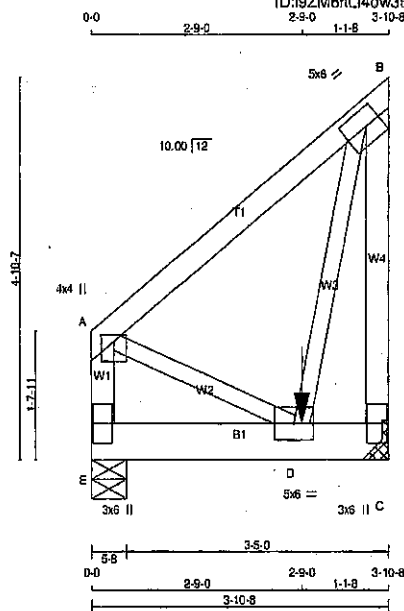

Scale = 1:27.0

TOTAL WEIGHT = 2 X 24 = 48 lb

CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY No.2	SPF
C - B	2x4	DRY No.2	SPF
E - A	2x4	DRY No.2	SPF
E - C	2x6	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
DRY: SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-B 1	12	TOP
B-C 1	12	TOP
E-A 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
E-C 2	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
A TMWV+p	MT20	4.0	4.0	1.00	2.00
B TMWV-l	MT20	5.0	6.0	2.50	2.50
C BMV1+p	MT20	3.0	5.0		
D BMWV-l	MT20	5.0	5.0		
E BMV1+p	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	1982	1982	0	0
C VERT	978	978	0	0
E VERT	978	978	0	0
JT HORZ	0	0	0	0
C HORZ	0	0	0	0
E HORZ	0	0	0	0
JT UPLIFT	0	0	0	0
C UPLIFT	0	0	0	0
E UPLIFT	0	0	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT C. MINIMUM BEARING LENGTH AT JOINT C = 4-0.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
C	1387	942	0	0	0	0	455	0
E	689	463	0	0	0	0	225	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	UNBRAC LENGTH	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO				FR-TO		
A-B	-816	-91.8	-91.8	0.13 (1)	6.25	A-D	0	0.05 (1)
C-B	-1585	0.0	0.0	0.28 (1)	7.81	D-B	0	0.23 (1)
E-A	-788	0.0	0.0	0.04 (1)	7.81			
E-D	0	-18.5	-18.5	0.17 (1)	10.00			
D-C	0	-18.5	-18.5	0.17 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
D	2-9-0	-2532	-2532	---	BACK	VERT	TOTAL	---	CI

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.5 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TO=0.28/1.00 (B-C:1), BC=0.17/1.00 (D-E:1), WB=0.23/1.00 (B-D:1), SS=0.13/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1687

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.72 (B) (INPUT = 0.90)
JSI METAL= 0.20 (D) (INPUT = 1.00)

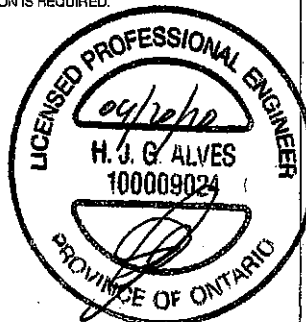


Structural component only
DWG# T-2006404

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408206	T31	1	2	TRUSS DESC.		

Tamarack Road Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Fri Apr 17 08:01:38 2020 Page 1
ID:9ZM6hU4ow3EYgKiUWHCzHzoLwRUCT?xntxCc8D7oSp4gk3J89VHDu0sDENTRzPuBR

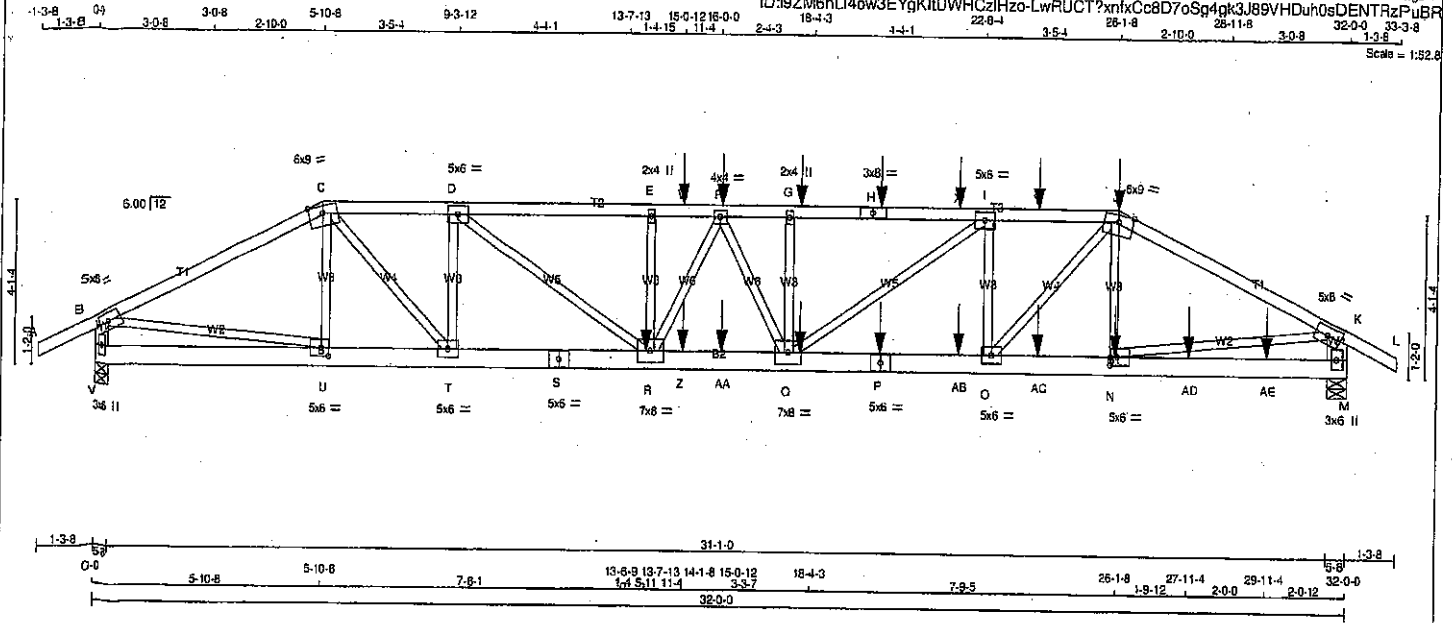

LUMBER	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES				
CHORDS				
A - C	2x4	DRY	No.2	SPF
C - H	2x4	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF
J - L	2x4	DRY	No.2	SPF
V - B	2x6	DRY	No.2	SPF
M - K	2x6	DRY	No.2	SPF
V - S	2x6	DRY	No.2	SPF
S - P	2x6	DRY	No.2	SPF
P - M	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS	#ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122'x3") SPIRAL NAILS			
A - C	1	12	TOP
C - H	1	12	SIDE (61.0)
H - J	1	12	SIDE (61.0)
J - L	1	12	SIDE (61.0)
V - B	2	12	TOP
M - K	2	12	TOP
BOTTOM CHORDS: (0.122'x3") SPIRAL NAILS			
V - S	2	12	TOP
S - P	2	12	SIDE (183.1)
P - M	2	12	SIDE (183.1)
WEBS: (0.122'x3") SPIRAL NAILS			
2x3	1	8	SIDE (313.8)
Q - G	1	5	
R - E	1	5	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-4	MT20	5.0	8.0			
C	TMWV-4	MT20	5.0	8.0			
D	TMWV-4	MT20	5.0	6.0			
E	TMWV-4	MT20	2.0	4.0			
F	TMWV-4	MT20	4.0	4.0			
G	TMWV-4	MT20	2.0	4.0			
H	TS-1	MT20	3.0	8.0			
I	TMWV-4	MT20	5.0	6.0			
J	TMWV-4	MT20	6.0	9.0			
K	TMWV-4	MT20	5.0	8.0			
M	BMV1-p	MT20	3.0	6.0			
N	BMWV-4	MT20	5.0	6.0	2.50	2.25	
O	BMWV-4	MT20	5.0	6.0			
P	BS-1	MT20	5.0	6.0			
Q	BMWV-4	MT20	7.0	8.0			
R	BMWV-4	MT20	7.0	8.0			
S	BS-1	MT20	5.0	5.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT 3370	DOWN 3370	0	5-8
V	3370	0	5-8	5-8
M	3670	0	5-8	5-8

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
V	2376	1597 0 0 0 0 0 0 0 0 0 0
M	2591	1727 0 0 0 0 0 0 0 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING	CHORDS	WEBS
TOTAL LOAD CASES: (4)		
	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
	VERT. LOAD (LBS)	MAX. UNBRACED LENGTH (IN)
	FROM TO	FROM TO
	A-B 0 / 28	-91.8 -91.8 0.07 (1)
	B-C -5182 / 0	-91.8 -91.8 0.53 (1)
	C-D -6810 / 0	-91.8 -91.8 0.30 (1)
	D-E -9346 / 0	-91.8 -91.8 0.55 (1)
	E-W -9346 / 0	-91.8 -91.8 0.59 (1)
	W-F -9346 / 0	-91.8 -91.8 0.38 (1)
	F-G -8840 / 0	-91.8 -91.8 0.39 (1)
	G-H -8840 / 0	-91.8 -91.8 0.59 (1)
	H-X -8840 / 0	-91.8 -91.8 0.59 (1)
	X-I -8840 / 0	-91.8 -91.8 0.59 (1)
	I-Y -7001 / 0	-91.8 -91.8 0.39 (1)
	Y-J -7001 / 0	-91.8 -91.8 0.39 (1)
	J-K -5653 / 0	-91.8 -91.8 0.57 (1)
	K-L 0 / 28	-91.8 -91.8 0.07 (1)
	V-B -3305 / 0	0.0 0.0 0.12 (1)
	M-K -3582 / 0	0.0 0.0 0.13 (1)
	V-U 0 / 0	-18.5 -18.5 0.05 (4)
	U-T 0 / 4599	-18.5 -18.5 0.32 (1)
	T-S 0 / 6810	-18.5 -18.5 0.53 (1)
	S-R 0 / 6810	-18.5 -18.5 0.53 (1)
	R-Z 0 / 9129	-18.5 -18.5 0.69 (1)
	Z-AA 0 / 9129	-18.5 -18.5 0.69 (1)
	AA-Q 0 / 9129	-18.5 -18.5 0.89 (1)
	Q-P 0 / 7001	-18.5 -18.5 0.52 (1)
	P-AB 0 / 7001	-18.5 -18.5 0.52 (1)
	AB-O 0 / 7001	-18.5 -18.5 0.52 (1)
	O-AC 0 / 5038	-18.5 -18.5 0.35 (1)
	AC-N 0 / 5038	-18.5 -18.5 0.35 (1)
	N-AD 0 / 0	-18.5 -18.5 0.07 (4)
	AD-AE 0 / 0	-18.5 -18.5 0.07 (4)
	AE-M 0 / 0	-18.5 -18.5 0.07 (4)

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC	LC1	MAX.	FACE	DIR.	TYPE	CONN.
F	16-0-12	-110	-110	-	FRONT	VERT	TOTAL	C1
G	18-0-12	-110	-110	-	FRONT	VERT	TOTAL	C1
H	20-0-12	-110	-110	-	FRONT	VERT	TOTAL	C1
J	26-1-8	-459	-459	-	FRONT	VERT	TOTAL	C1
N	26-0-12	-26	-26	-	FRONT	VERT	TOTAL	C1
P	20-0-12	-26	-26	-	FRONT	VERT	TOTAL	C1
Q	18-0-12	-26	-26	-	FRONT	VERT	TOTAL	C1
R	14-1-8	-1904	-1904	-	FRONT	VERT	TOTAL	C1

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.07")
CALCULATED VERT. DEFL. (LL) = L/999 (0.25")
ALLOWABLE DEFL. (TL) = L/360 (1.07")
CALCULATED VERT. DEFL. (TL) = L/856 (0.45")

CSI: TC=0.59/1.00 (G-I:1), BC=0.69/1.00 (Q-R:1), WB=0.69/1.00 (K-N:1), SS=0.17/1.00 (G-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1907 1698

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.87 (T) (INPUT = 0.90)
JSI METAL= 0.67 (S) (INPUT = 1.00)

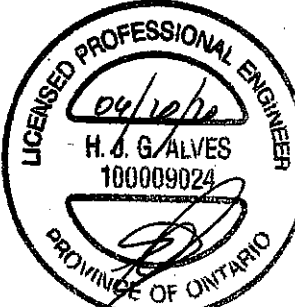

Structural component only 1/2
DWG# T-2006409

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408206	T31	1	2	GREEN PARK HOMES	
Tamarack Floor Truss, Burlington					
TRUSS DESC.					

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Fri Apr 17 08:01:38 2020 Page 2

ID: i9ZM6hLj4ow3EYqKIUWHCzIHzo-LwRUCT?xntxCc8D7o8g4gk3J89VHDuh0sDENTRzPuBR

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
T	BMWW-t	MT20	5.0	6.0		
U	BMWW-t	MT20	5.0	6.0	2.50	2.25
V	BMV1-p	MT20	3.0	5.0		


Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
W	15-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	22-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	24-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	15-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AA	16-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AB	22-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AC	24-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AD	27-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AE	28-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

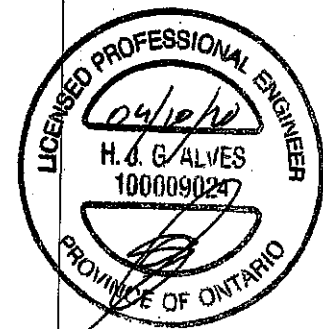

Structural component only
DWG# T-2006409

42

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408206	T31Z	1	2	TRUSS DESC.		


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Fri Apr 17 08:01:40 2020 Page 1

ID:9ZM6hL4ow3EYgKIUWHCzHzo-HIZF690BGCwrSNWwIYI99fzzChmqJXIXKzPuBF

1-3-8 0-0 3-8 3-0-8 2-10-0 5-10-8 2-0-12 7-11-4 9-3-12 4-4-1 13-7-13 16-0-0 18-1-3 2-4-3 2-4-3 22-8-1 3-5-1 26-1-8 2-10-0 25-11-8 3-0-8 1-3-8

Scale = 1:32.0

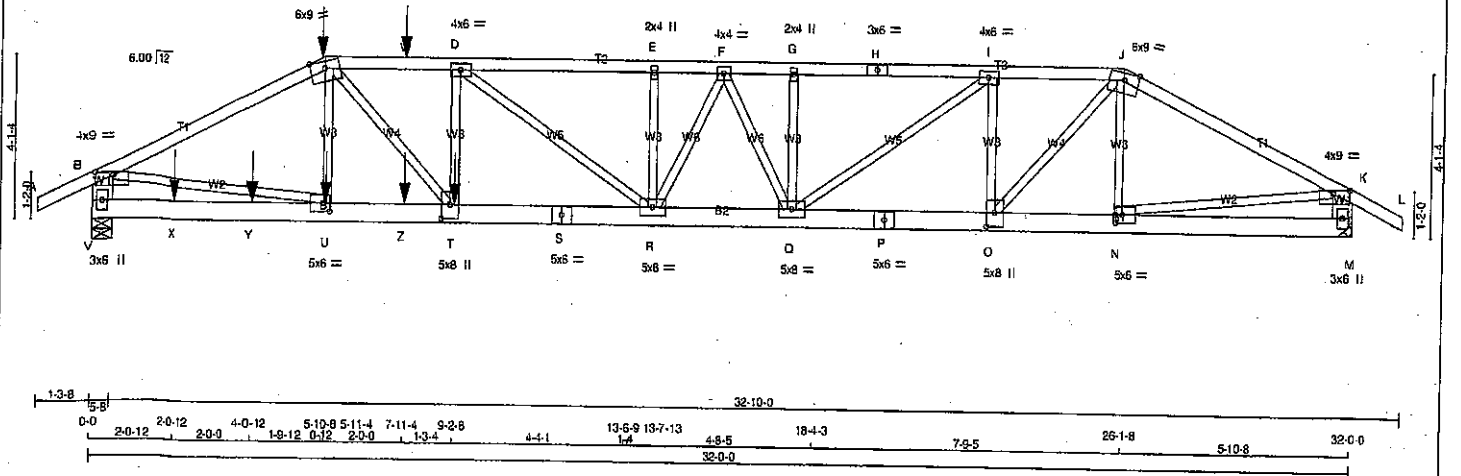

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES	A - C	2x4	DRY	No.2	SPF
	C - H	2x4	DRY	No.2	SPF
	H - J	2x4	DRY	No.2	SPF
	J - L	2x4	DRY	No.2	SPF
	V - B	2x6	DRY	No.2	SPF
	M - K	2x6	DRY	No.2	SPF
	V - S	2x6	DRY	No.2	SPF
	S - P	2x6	DRY	No.2	SPF
	P - M	2x6	DRY	No.2	SPF
	ALL WEBS	2x3	DRY	No.2	SPF
	EXCEPT				

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C	12	SIDE(61.0)
C-H	12	SIDE(61.0)
H-J	12	TOP
J-L	12	TOP
V-B	2	TOP
M-K	2	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
V-S	2	SIDE(183.1)
S-P	2	TOP
P-M	2	TOP
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	6	SIDE(426.9)
D-T	1	
L-O	1	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	4.0	9.0	1.00 4.75
C	TTWW-m	MT20	6.0	9.0	Edge
D	TMWV-i	MT20	4.0	9.0	
E	TMWV-w	MT20	2.0	4.0	
F	TMWV-i	MT20	4.0	4.0	
G	TMWV-w	MT20	2.0	4.0	
H	TS-i	MT20	3.0	8.0	
I	TMWV-i	MT20	4.0	6.0	
J	TTWW-m	MT20	6.0	9.0	Edge
K	TMWV-p	MT20	4.0	9.0	1.00 4.75
M	BMWV-i	MT20	3.0	6.0	
N	BMWV-i	MT20	5.0	6.0	2.50 2.00
O	BMWV-i	MT20	5.0	8.0	4.25 2.50
P	BS-i	MT20	5.0	6.0	
Q	BMWV-i	MT20	5.0	8.0	
R	BMWV-i	MT20	5.0	8.0	
S	BS-i	MT20	5.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	UP	IN-SX
V	4101	0	0	5-8
M	2890	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT M. MINIMUM BEARING LENGTH AT JOINT M = 4-0.

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED
V	2893
M	1897

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.23 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1: MAX (PLF)	MEMB.	FORCE (LBS)
FR-TO			FR-TO	
A-B	0.28	-91.8	B-U	0.5787
B-C	-6420.0	-91.8	C-T	-549.0
C-W	-7889.0	-91.8	T-D	-3395.0
W-D	-7889.0	-91.8	D-T	-177.0
D-E	-7575.0	-91.8	E-J	-1685.0
E-F	-7575.0	-91.8	J-O	0.2387
F-G	-6791.0	-91.8	O-N	-399.0
G-H	-6791.0	-91.8	N-K	0.3572
H-I	-6791.0	-91.8	K-I	0.2076
I-J	-5124.0	-91.8	J-R	-516.0
J-K	-3883.0	-91.8	R-F	-398.0
K-L	0.28	-91.8	F-E	-390.0
L-O	-4015.0	0.0	O-I	0.918
M-K	-2629.0	0.0	I-Q	-909.0
V-X	0.0	-18.5	Q-Q	0.07 (4)
X-Y	0.0	-18.5	Y-U	0.07 (4)
Y-U	0.0	-18.5	U-Z	0.07 (4)
U-Z	0.5723	-18.5	Z-T	0.5723
Z-T	0.5723	-18.5	T-S	0.5723
T-S	0.7989	-18.5	S-R	0.7989
S-R	0.7989	-18.5	R-Q	0.7181
R-Q	0.7181	-18.5	Q-P	0.5124
Q-P	0.5124	-18.5	P-O	0.5124
P-O	0.5124	-18.5	O-N	0.3632
O-N	0.3632	-18.5	N-M	0.0
N-M	0.0	-18.5		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.
C	5-10-8	-459	-459	---	BACK	VERT
T	9-2-8	-2338	-2338	---	BACK	VERT
U	5-11-4	-26	-26	---	BACK	VERT
W	7-11-4	-110	-110	---	BACK	VERT
X	2-0-12	-26	-26	---	BACK	VERT
Y	4-0-12	-26	-26	---	BACK	VERT
Z	7-11-4	-26	-26	---	BACK	VERT

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.07")
CALCULATED VERT. DEFL.(LL) = L/999 (0.20")
ALLOWABLE DEFL.(TL) = L/360 (1.07")
CALCULATED VERT. DEFL.(TL) = L/999 (0.37")

CSI: TC=0.84/1.00 (B-C:1), BC=0.59/1.00 (R-T:1), WB=0.72/1.00 (B-U:1), SS=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1696

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

ISI GRIP= 0.90 (IN) (INPUT = 0.90)
ISI METAL= 0.75 (S) (INPUT = 1.00)

Structural component only
DWG# T-2006410

CONTINUED ON PAGE 2

JOB NAME 408206	TRUSS NAME T31Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:01:40 2020 Page 2
ID:9ZM6hLI4cw3EYgKIUWHCzIHzo-HIZFc90BIGCwrSNWwtYI99fzzCIhmqJJXjUXKzPuBF


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
T	BMWVW-H	MT20	5.0	8.0	4.25	2.50
U	BMWVW-H	MT20	5.0	6.0	2.50	2.00
V	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

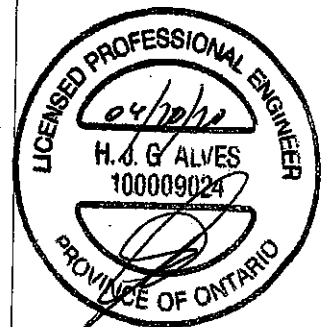


Structural component only
DWG# T-2006410

1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408206	T32	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Fri Apr 17 08:01:41 2020 Page 1
ID:1KkO77G6t8KLXoXQOnZrb?zIFJT-IU7dqV1p3aKnTcxTaDnINhuRNboQNSYBT13mzPuBC

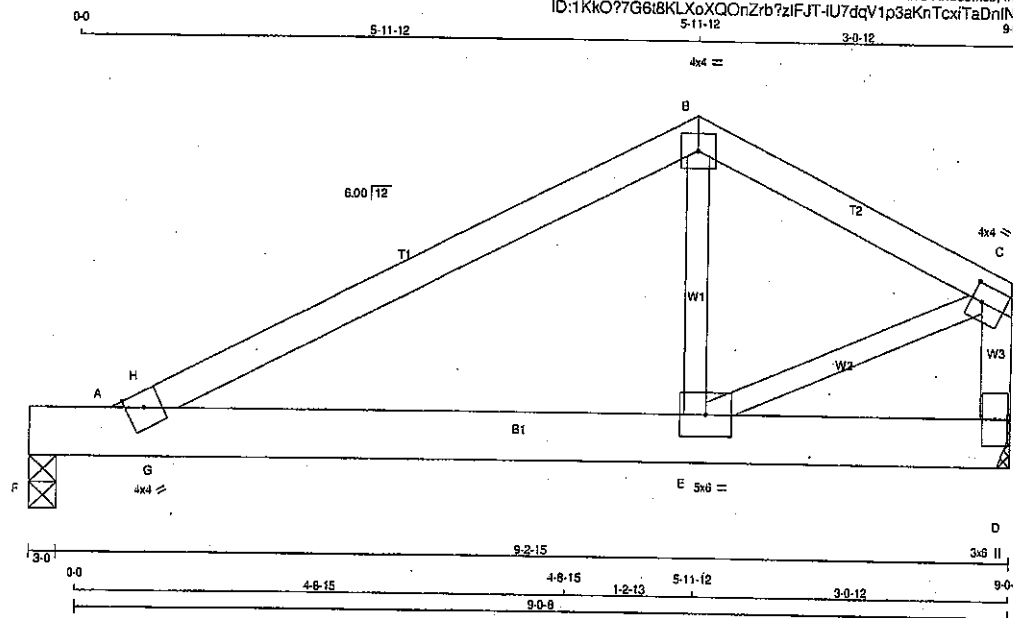

TOTAL WEIGHT = 2 X 34 = 68 lb

LUMBER

N. L. G. A. RULES

CHORDS SIZE

A - B 2x4 DRY

S - C 2x4 DRY

D - C 2x4 DRY

F - D 2x6 DRY

ALL WEBS 2x3 DRY

DRY: SEASONED LUMBER.

LUMBER

No.2

No.2

No.2

No.2

No.2

No.2

DESCR.

SPF

SPF

SPF

SPF

SPF

SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
F	524	0	524	0
D	524	0	524	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	370	243.0	0.0	0.0	0.0	127.0	0.0
D	370	243.0	0.0	0.0	0.0	127.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)	MAX. FACTORED VERT. LOAD (LC4)	MAX. FACTORED VERT. LOAD (LC5)	MAX. FACTORED VERT. LOAD (LC6)	MAX. FACTORED VERT. LOAD (LC7)	MAX. FACTORED VERT. LOAD (LC8)	MAX. FACTORED VERT. LOAD (LC9)	MAX. FACTORED VERT. LOAD (LC10)
FR-TO													
A-H		-378.0	-91.8	-91.8	0.20 (1)	6.25	6.25	6.25	6.25	6.25	6.25	6.25	6.25
H-B		-524.0	-91.8	-91.8	0.33 (1)	6.25	6.25	6.25	6.25	6.25	6.25	6.25	6.25
B-C		-511.0	-91.8	-91.8	0.15 (1)	6.25	6.25	6.25	6.25	6.25	6.25	6.25	6.25
D-C		-572.0	0.0	0.0	0.08 (1)	7.81	7.81	7.81	7.81	7.81	7.81	7.81	7.81
F-A		0.0	-110.3	-110.3	0.25 (1)	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00
A-G		0.457	-18.5	-18.5	0.45 (1)	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00
G-E		0.457	-18.5	-18.5	0.45 (1)	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00
E-D		0.0	-18.5	-18.5	0.16 (1)	10.00	10.00	10.00	10.00	10.00	10.00	10.00	10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.32")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.05")
ALLOWABLE DEFL.(TL) = $L/360$ (0.32")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.10")

CSI: TC=0.33/1.00 (B-H:1), BC=0.45/1.00 (A-G:1), WB=0.11/1.00 (C-E:1), SS=0.32/1.00 (A-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1856

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


SSI GRIP= 0.78 (C) (INPUT = 0.80)
SSI METAL = 0.22 (C) (INPUT = 1.00)

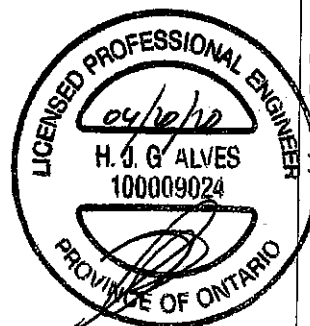

Structural component only
DWG# T-2006411

JOB NAME 408206	TRUSS NAME T33	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitel Industries, Inc. Fri Apr 17 08:01:42 2020 Page 1
ID:1KkQ77G6i8KLXoXQOnZrb?zIFJT-Dhh?1q2RqtSd5IWV1k0qaE2um?M9pXcnrCbcCzPuBN

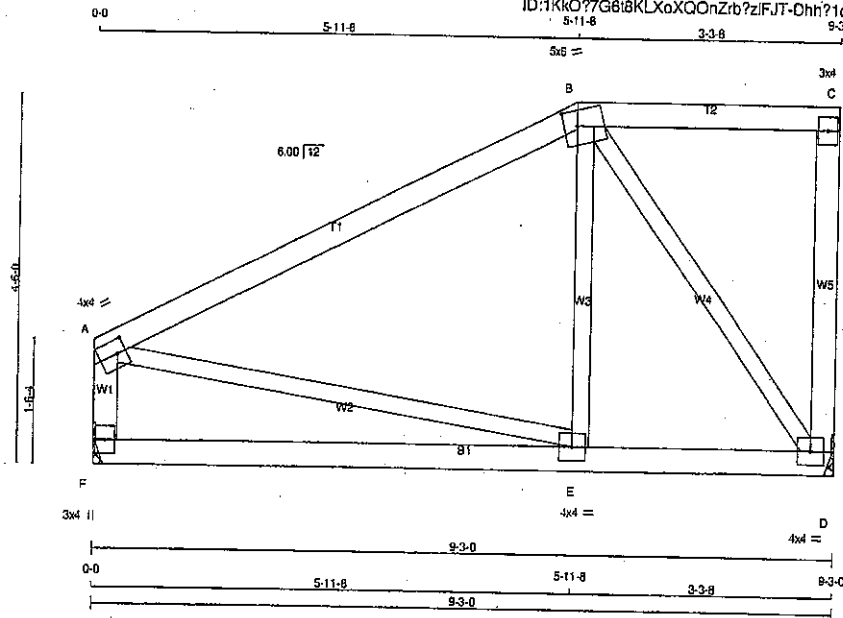

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - A	2x4	DRY	No.2
F - D	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY, SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	4.0	4.0	2.00	1.25
B	TTWW-m	MT20	5.0	5.0	2.25	2.00
C	TMV-p	MT20	3.0	4.0		
D	BMVW1-t	MT20	4.0	4.0		
E	BMVW-t	MT20	4.0	4.0		
F	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING DESIGNER		DESIGNED BY: [REDACTED] TO BE VERIFIED BY: [REDACTED]						
BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQRD	
GROSS REACTION		GROSS REACTION				BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
D	510	0	510	0	0	MECHANICAL		
F	510	0	510	0	0	MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D, F. MINIMUM BEARING LENGTH AT JOINT D = 1-8, JOINT F = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	361	237.0	0.0	0.0	0.0	124.0	0.0
F	361	237.0	0.0	0.0	0.0	124.0	0.0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	UNBRACED LENGTH (FT)
FR-TO		FROM	TO	FR-TO			
A-B	-303.0	-91.8	-91.8	0.42 (1)	6.25	E-B	0.108
B-C	0.0	-91.8	-91.8	0.17 (1)	10.00	B-D	-441.0
D-C	-151.0	0.0	0.0	0.05 (1)	7.81	A-E	0.276
F-A	-483.0	0.0	0.0	0.05 (1)	7.81		
F-E	0.0	-18.5	-18.5	0.14 (4)	10.00		
E-D	0.272	-18.5	-18.5	0.17 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.31")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.31")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.42/1.00 (A-B:1), GC=0.17/1.00 (D-E:4), WB=0.19/1.00 (B-D:1), SS=0.19/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 L.S BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

SI GRIP= 0.48 (A) (INPUT = 0.90)
SI METAL= 0.16 (A) (INPUT = 1.00)

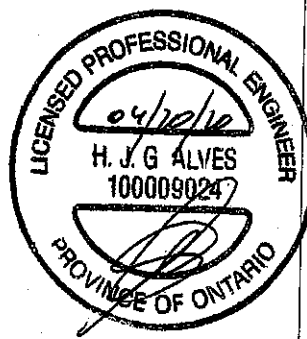


Structural component only
DWG# T-2006412

JOB NAME	TRUSS NAME	QUANTITY	PLY.	JOB DESC.	DRWG NO.
408206	T34	1	2	GREEN PARK HOMES	

Tamarack RodTruss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:01:43 2020 Page 1
ID:1KkO77G6IBKXoXQOnZrb?zIFJT-ItENFA24bBaUjv55b?FFNonGVAJWJF1?Vy88fzPUBM

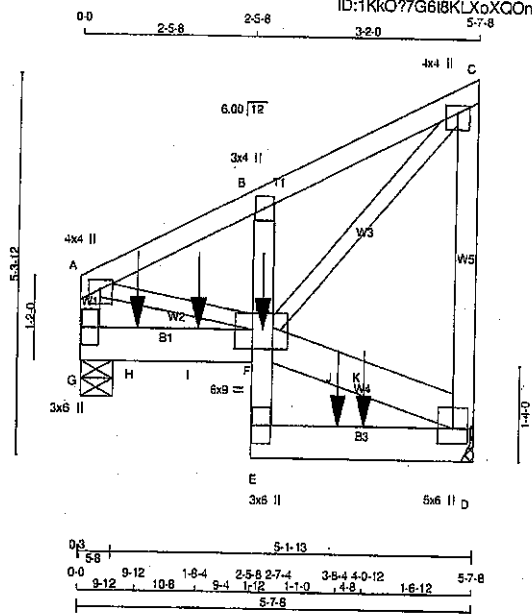

Scale = 1/2" = 1'-0"

LUMBER	N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	
G - A	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
E - B	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
F - D	2x6	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
C - D	12	TOP
G - A	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
G - F	12	SIDE(81.0)
E - D	12	SIDE(0.0)
B - E	12	SIDE(72.6)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	
2x6	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (tables in inches)

JT TYPE	PLATES	W	LEN	Y	X
A TMVW+p	MT20	4.0	4.0	1.50	2.00
B TMV+p	MT20	3.0	4.0		
C TMVW+p	MT20	4.0	4.0	1.25	2.00
D BMVW+p	MT20	5.0	6.0	2.50	2.50
E BMV+p	MT20	3.0	6.0		
F BVWVW+p	MT20	6.0	9.0	3.25	3.00
G BMV+p	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	1481	1481	0	0
D HORIZ	0	0	0	0
G HORIZ	1941	1941	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 2'-0".

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	1043	709	0	0	0	333	0
G	1355	941	0	0	0	423	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			FACTORED			WEBS		
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MEMB.	FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO		FROM TO	CSI (LC)	MAX. UNBRAC LENGTH	FR-TO			MAX. FACTORED VERT. LOAD (LBS)
A-B	-1513 / 0	-91.8	-91.8	0.05 (1)	6.25	F-D	-74 / 0	0.00 (1)
B-C	-1486 / 0	-91.8	-91.8	0.08 (1)	6.25	F-C	0 / 2029	0.25 (1)
D-C	-1029 / 0	0.0	0.0	0.23 (1)	7.81	A-F	0 / 1418	0.18 (1)
G-A	-1187 / 0	0.0	0.0	0.07 (1)	7.81			
G-H	0 / 0	-18.5	-18.5	0.22 (1)	10.00			
H-I	0 / 0	-18.5	-18.5	0.22 (1)	10.00			
I-F	0 / 0	-18.5	-18.5	0.22 (1)	10.00			
E-F	0 / 562	0.0	0.0	0.12 (1)	10.00			
F-B	-257 / 0	0.0	0.0	0.07 (1)	7.81			
E-J	0 / 67	-18.5	-18.5	0.24 (1)	10.00			
J-K	0 / 67	-18.5	-18.5	0.24 (1)	10.00			
K-D	0 / 67	-18.5	-18.5	0.24 (1)	10.00			

REGISTERED PROFESSIONAL

04/26/16

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR
F	2'-7.4	-512	-512	---	FRONT	VERT
H	9'-12	-507	-507	---	FRONT	VERT
H	9'-12	-240	-240	---	TOP	VERT
I	1'-8.4	-615	-615	---	BACK	VERT
J	3'-8.4	-436	-436	---	BACK	VERT
K	4'-0-12	-491	-491	---	FRONT	VERT

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 37 = 74 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.8	PSF
	DL	= 8.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.18")
CALCULATED VERT. DEFL.(LL) = L/899 (0.01")
ALLOWABLE DEFL.(TL) = L/380 (0.18")
CALCULATED VERT. DEFL.(TL) = L/899 (0.03")

CSI: TC=0.23/1.00 (C-D:1), BC=0.24/1.00 (D-E:1), WB=0.25/1.00 (C-F:1), SS=0.25/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (FSD) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1567 788 1987 1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

SI GRIP = 0.88 (C) (INPUT = 0.90)
SI METAL = 0.33 (C) (INPUT = 1.00)

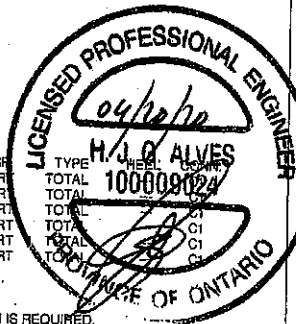

Structural component only
DWG# T-2006413

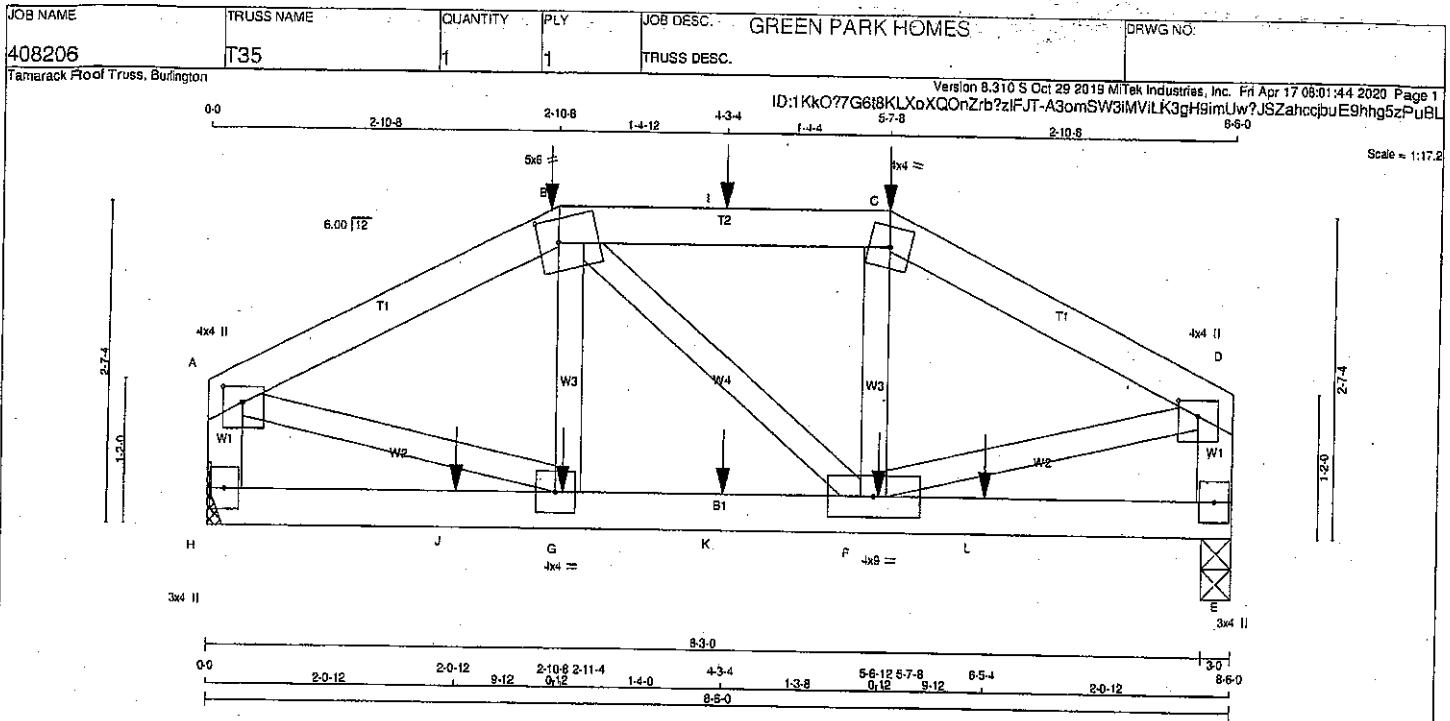

LUMBER

N.L.C.A. RULES	CHORDS	SIZE	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
J - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - N	2x4	DRY	No.2
N - O	2x4	DRY	No.2
O - P	2x4	DRY	No.2
P - Q	2x4	DRY	No.2
Q - R	2x4	DRY	No.2
R - S	2x4	DRY	No.2
S - T	2x4	DRY	No.2
T - U	2x4	DRY	No.2
U - V	2x4	DRY	No.2
V - W	2x4	DRY	No.2
W - X	2x4	DRY	No.2
X - Y	2x4	DRY	No.2
Y - Z	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.50	2.00
B	TTWW-m	MT20	5.0	6.0	2.25	2.00
C	TTW-m	MT20	4.0	4.0		
D	TMVW+p	MT20	4.0	4.0	1.50	2.00
E	BMV1+p	MT20	3.0	4.0		
F	BMVWW-t	MT20	4.0	9.0		
G	BMVWW-t	MT20	4.0	4.0		
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	HORIZ	DOWN	HORIZ
H 633	0	633	0
E 633	0	633	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 1-8.

UNFACTORED REACTIONS

1ST CASE	MAX/MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
H 447	289 / 0 0 / 0 0 / 0 0 0 148 0 0 0
E 447	289 / 0 0 / 0 0 / 0 0 0 148 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLINE SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO		FROM TO	CS1 (LC)	FR-TO		FROM TO	CS1 (LC)
A-B	-672 / 0	-91.8 -91.8	0.15 (1)	G-B	-110 / 15	0.02 (1)	
B-I	-598 / 0	-91.8 -91.8	0.14 (1)	B-F	0 / 2	0.00 (4)	
I-C	-598 / 0	-91.8 -91.8	0.14 (1)	F-C	-107 / 17	0.02 (1)	
C-D	-677 / 0	-91.8 -91.8	0.15 (1)	A-G	0 / 824	0.15 (1)	
H-A	-606 / 0	0.0 0.0	0.07 (1)	F-D	0 / 828	0.16 (1)	
E-D	-605 / 0	0.0 0.0	0.07 (1)				
H-J	0 / 0	-18.5 -18.5	0.04 (4)				
J-G	0 / 0	-18.5 -18.5	0.04 (4)				
G-K	0 / 595	-18.5 -18.5	0.12 (1)				
K-F	0 / 595	-18.5 -18.5	0.12 (1)				
F-L	0 / 0	-18.5 -18.5	0.04 (4)				
L-E	0 / 0	-18.5 -18.5	0.04 (4)				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TOTAL
B	2-10-8	-149	-149		BACK	VERT	149
C	5-7-8	-149	-149		BACK	VERT	149
F	5-6-12	-5	-5		BACK	VERT	5
G	2-11-4	-5	-5		BACK	VERT	5
I	4-3-4	-7	-7		BACK	VERT	7
J	2-0-12	-5	-5		BACK	VERT	5
K	4-3-4	-5	-5		BACK	VERT	5
L	6-5-4	-5	-5		BACK	VERT	5

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.28")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CS1: TC=0.15/1.00 (C-D-1), BC=0.12/1.00 (F-G-1), WB=0.16/1.00 (D-F-1), SS=0.11/1.00 (B-C-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618 354 1667 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.74 (G) (INPUT = 0.90)
JSI METAL= 0.22 (G) (INPUT = 1.00)


JOB NAME 408206	TRUSS NAME T36A	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Fri Apr 17 08:01:46 2020 Page 1

ID:1KkO77G618KLXoXQOnZrb?zIFJT-6SwwIC5yu6y3aNgG7py?QPm4CNZ4fbBhTAd_zPuBj

Scale = 1:27.4

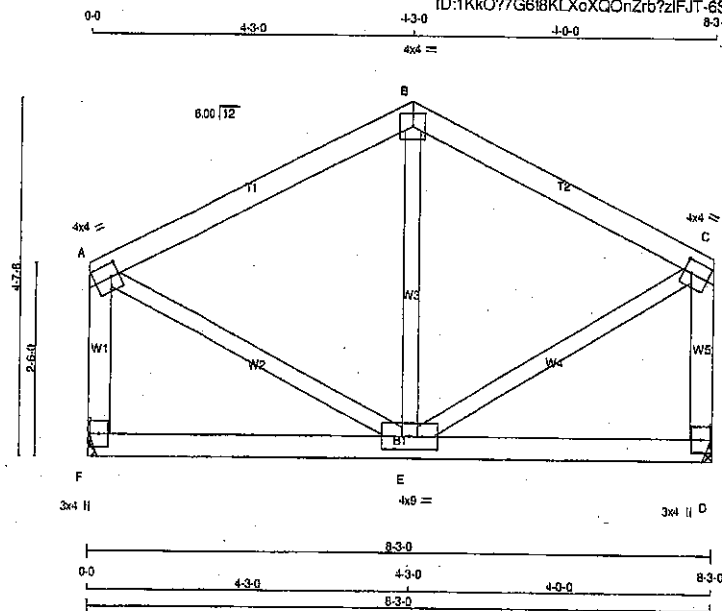

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
F - A	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY, SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	4.0	4.0	2.00	1.25
B	TTW-p	MT20	4.0	4.0		
C	TMVW-1	MT20	4.0	4.0	2.00	1.25
D	BMV1+p	MT20	3.0	4.0		
E	BMVWW-1	MT20	4.0	9.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
F	VERT 455	HORZ 0	DOWN 455	HORZ 0
D	VERT 455	HORZ 0	UP/LIFT 0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. D. MINIMUM BEARING LENGTH AT JOINT F = 1-8, JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
F	COMBINED	SNOW 211.0	LIVE 0.0	0.0	0.0	111.0
D	COMBINED	SNOW 211.0	LIVE 0.0	0.0	0.0	111.0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC)
FR-TO							FR-TO			
A-B	-252.0	-91.8	-91.8	0.21 (1)	6.25	E-B	-153.14	0.05 (1)		
B-C	-252.0	-91.8	-91.8	0.19 (1)	6.25	A-E	0.253	0.06 (1)		
F-A	-424.0	0.0	0.0	0.06 (1)	7.81	E-C	0.260	0.06 (1)		
D-C	-427.0	0.0	0.0	0.06 (1)	7.81					
F-E	0.0	-18.5	-18.5	0.09 (4)	10.00					
E-D	0.0	-18.5	-18.5	0.09 (4)	10.00					

TOTAL WEIGHT = 35 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.28")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.21/1.00 (A-B:1), BC=0.09/1.00 (E-F:4), WB=0.06/1.00 (C-E:1), SS=0.14/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 789

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.39 (C) (INPUT = 0.90)
JSI METAL= 0.13 (A) (INPUT = 1.00)



Structural component only
DWG# T-2006415

Structural component only
DWG# T-2006416

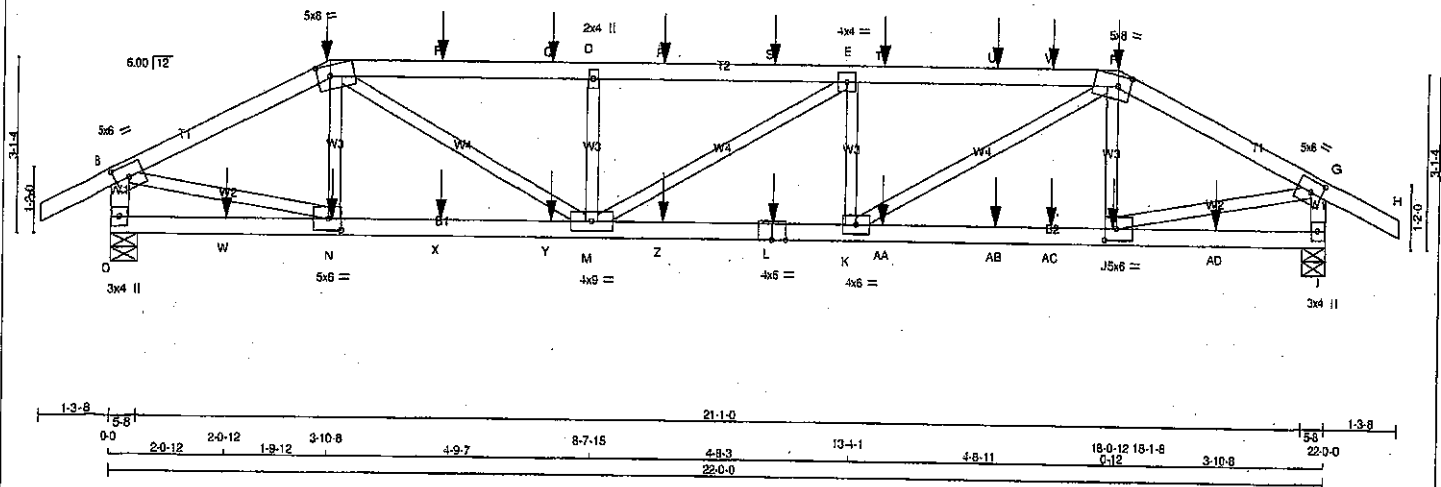

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
O - B	2x4	DRY	No.2
I - G	2x4	DRY	No.2
O - L	2x4	DRY	No.2
L - I	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	6.0	2.50	2.75
C	TTWW-m	MT20	5.0	8.0	2.25	2.75
D	TMVW-w	MT20	2.0	4.0		
E	TMVW-t	MT20	4.0	4.0		
F	TTWW-m	MT20	5.0	8.0	2.25	2.75
G	TMVW-t	MT20	5.0	8.0	2.50	2.75
I	BMV1+p	MT20	3.0	4.0		
J	BMVW-t	MT20	5.0	6.0	2.50	2.50
K	BMVW-t	MT20	4.0	8.0		
L	BS-t	MT20	4.0	8.0		
M	BMVW-t	MT20	4.0	9.0		
N	BMVW-t	MT20	5.0	6.0	2.50	2.75
O	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECD	
JT	VERT	GROSS	REACTION	DOWN	HORIZ	UPLIFT	IN-SX	BRG	IN-SX
O	1784	0	1784	0	0	5-8	5-8	5-8	5-8
I	1811	0	1811	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
O	1259	842.0	0.0	0.0	0.0	416.0	0.0
I	1278	854.0	0.0	0.0	0.0	424.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.30 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED	MEMB.	MAX. FACTORED
FR-TO	FORCE (LBS)	FR-TO	FORCE (LBS)
A-B	0.28	N-C	-315.0
B-C	-2257.0	C-M	0.1371
C-P	-3188.0	M-D	-568.0
P-Q	-3188.0	D-E	-32.0
Q-D	-3188.0	E-F	-572.0
D-R	-3188.0	R-K	0.1357
R-S	-3188.0	S-F	-315.0
S-E	-3188.0	F-N	0.2063
E-T	-3215.0	J-G	0.2103
T-U	-3215.0		
U-V	-3215.0		
V-F	-3215.0		
F-G	-2300.0		
G-H	0.28		
O-B	-1750.0		
I-G	-1778.0		
O-W	0.0		
W-N	0.0		
N-X	0.2005		
X-Y	0.2005		
Y-M	0.2005		
M-Z	0.3215		
Z-L	0.3215		
L-K	0.3215		
K-AA	0.2044		
AA-AB	0.2044		
AB-AC	0.2044		
AC-J	0.2044		
J-AD	0.0		
AD-I	0.0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	3-10-8	-248	-248	FRONT	VERT	TOTAL	--	C1
F	18-1-8	-248	-248	FRONT	VERT	TOTAL	--	C1
J	18-0-12	-12	-12	FRONT	VERT	TOTAL	--	C1
L	11-11-4	-12	-12	FRONT	VERT	TOTAL	--	C1
N	3-11-4	-12	-12	FRONT	VERT	TOTAL	--	C1
P	5-11-4	-42	-42	FRONT	VERT	TOTAL	--	C1
Q	7-11-4	-42	-42	FRONT	VERT	TOTAL	--	C1
R	9-11-4	-42	-42	FRONT	VERT	TOTAL	--	C1
S	11-11-4	-42	-42	FRONT	VERT	TOTAL	--	C1

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.73")
 CALCULATED VERT. DEFL.(LL) = $L/999$ (0.13")
 ALLOWABLE DEFL.(TL) = $L/360$ (0.73")
 CALCULATED VERT. DEFL.(TL) = $L/999$ (0.25")

CSI: TC=0.58/1.00 (E-F:1), BC=0.64/1.00 (K-M:1),
 WB=0.52/1.00 (G-J:1), SSI=0.29/1.00 (E-F:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLJ) (PLJ)
 MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (G) (INPUT = 0.90)
 JSI METAL = 0.74 (L) (INPUT = 1.00)


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC	DRWG NO.
408206	T38	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:01:48 2020 Page 2
ID:9ZM6hLI4ow3EYgKlIUWHCziHzo-2r2Glu6CQjCnpg 2OYrQ4rU0cBxRYRtU9nfvpzPvBH

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
T	13-11-4	-42	-42	---	FRONT	VERT	TOTAL	---	C1
U	15-11-4	-42	-42	---	FRONT	VERT	TOTAL	---	C1
V	16-11-4	-42	-42	---	FRONT	VERT	TOTAL	---	C1
W	2-0-12	-12	-12	---	FRONT	VERT	TOTAL	---	C1
X	5-11-4	-12	-12	---	FRONT	VERT	TOTAL	---	C1
Y	7-11-4	-12	-12	---	FRONT	VERT	TOTAL	---	C1
Z	9-11-4	-12	-12	---	FRONT	VERT	TOTAL	---	C1
AA	13-11-4	-12	-12	---	FRONT	VERT	TOTAL	---	C1
AB	15-11-4	-12	-12	---	FRONT	VERT	TOTAL	---	C1
AC	16-11-4	-12	-12	---	FRONT	VERT	TOTAL	---	C1
AD	19-11-4	-12	-12	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

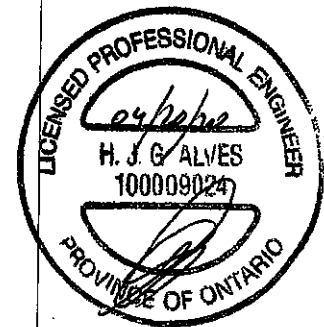


Structural component only
DWG# T-2006417

JOB NAME 408206	TRUSS NAME T40	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 17 08:01:51 2020 Page 1
ID:1KkO77G6t8KLXoXQOnZrb?zIFJT-TQjPwv95jeaMg8id3gO7U6ePPydrUwrluZQBzPuBB

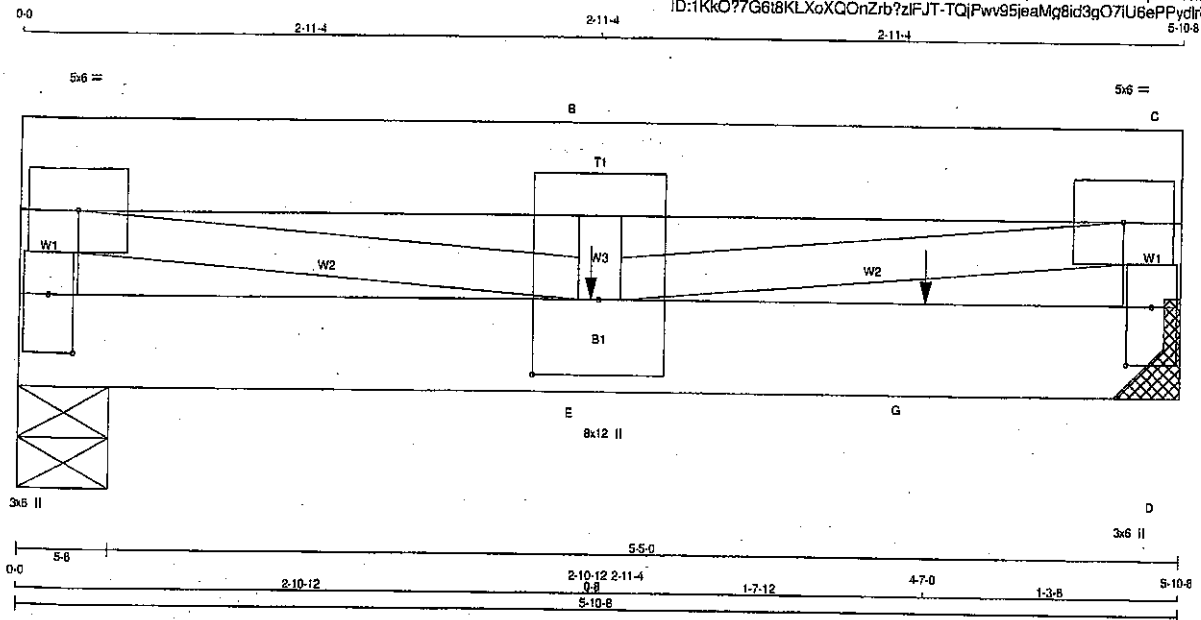

TOTAL WEIGHT = 2 X 27 = 53 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - A	2x4	DRY	No.2	SPF	
A - C	2x8	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	
F - D	2x8	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
F - A	12	TOP
C - D	12	TOP
A - C	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
F - D	12	SIDE (183.1)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	5.0	6.0		
B						
C	TMVW-1	MT20	5.0	6.0		
D	BMV1+p	MT20	3.0	6.0	3.50	1.50
E						
F	TMBMWWW-4	MT20	8.0	12.0	4.50	4.00
	BMV1+p	MT20	3.0	6.0	3.50	1.50

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
F	1073	0	1073	0
D	2357	0	2357	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	757	509 / 0	0 / 0	0 / 0	0 / 0	248	0	0
D	1861	1121 / 0	0 / 0	0 / 0	0 / 0	540	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. FACTORED VERT. LOAD (PLF)	LC1	MAX. FACTORED VERT. LOAD (PLF)	LC1	MAX. FACTORED VERT. LOAD (PLF)	LC1
F-A	-1066 / 0	0.0	0.0	0.08 (1)	7.81	A-E	0 / 2727	0.34 (1)	
A-B	-2814 / 0	-91.8	-91.8	0.17 (1)	8.25	E-B	0 / 58	0.01 (4)	
B-C	-2814 / 0	-91.8	-91.8	0.17 (1)	8.25	E-C	0 / 2727	0.34 (1)	
D-C	-1066 / 0	0.0	0.0	0.08 (1)	7.81				
F-E	0 / 0	-18.5	-18.5	0.02 (1)	10.00				
E-G	0 / 0	-18.5	-18.5	0.01 (1)	10.00				
G-D	0 / 0	-18.5	-18.5	0.01 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	2-10-12	-491	-491	---	BACK	VERT	TOTAL	---	C1
G	4-7-0	-2291	-2291	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
A - C LL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.03")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSI: TC=0.17/1.00 (A-B:1), BC=0.61/1.00 (D-E:1), WB=0.34/1.00 (A-E:1), SS=0.43/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

USI GRIP= 0.75 (E) (INPUT = 0.90)
USI METAL= 0.33 (C) (INPUT = 1.00)

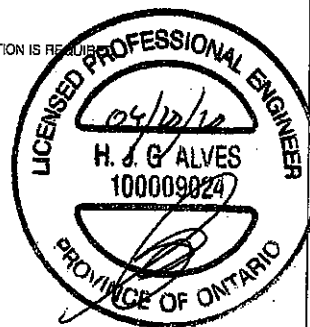

Structural component only
DWG# T-2006419

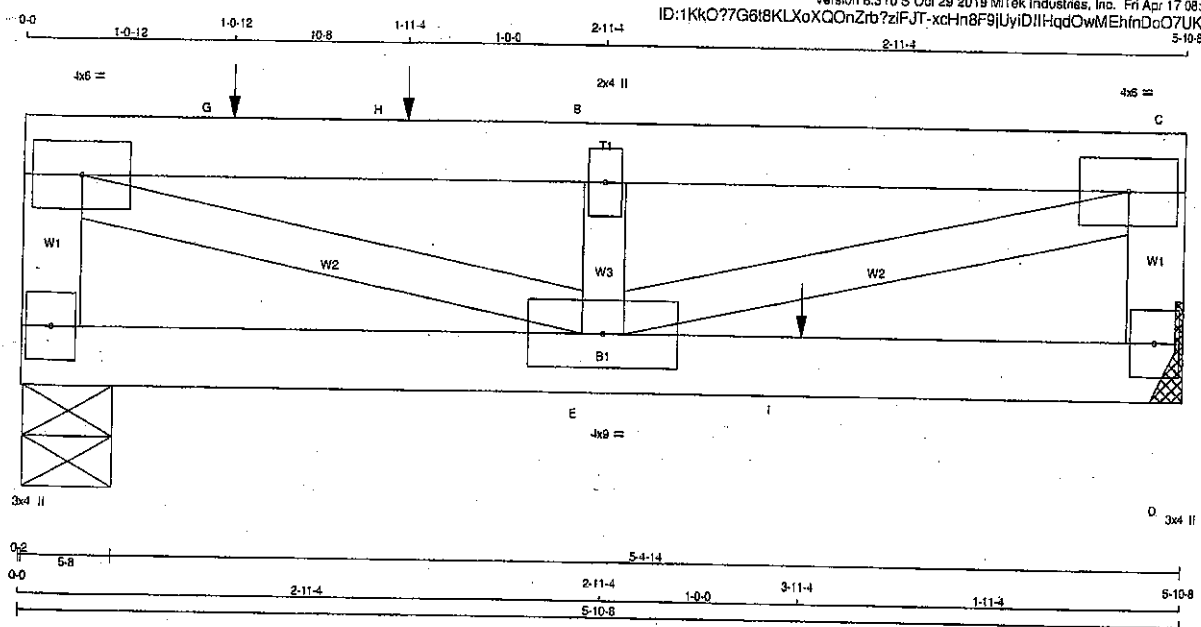

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - A	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
F - A	12	TOP
A - C	12	TOP
C - D	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
F - D	12	SIDE(0.0)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-I	MT20	4.0	6.0		
B	TMVW-w	MT20	2.0	4.0		
C	TMVW-I	MT20	4.0	6.0		
D	BMV1+p	MT20	3.0	4.0		
E	BMVWW-I	MT20	4.0	9.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	IN-SX	IN-SX
F	974	974	0	5-8
D	827	827	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 2-0.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	688	457.0	0.0	0.0	0.0	231.0	0.0
D	583	389.0	0.0	0.0	0.0	194.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.20 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. (PLF)	MAX. FACTORED LC1 MAX. (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. (PLF)	MAX. FACTORED LC1 MAX. (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
F-A	-983.0	0.0	0.0	0.05 (1)	A-E	0.1787	0.22 (1)
A-G	-1684.0	-91.8	-91.8	0.30 (1)	E-B	-821.0	0.06 (1)
G-H	-1684.0	-91.8	-91.8	0.30 (1)	B-C	0.1787	0.22 (1)
H-I	-1684.0	-91.8	-91.8	0.30 (1)	C-D	-866.0	0.0
I-J	-1684.0	-91.8	-91.8	0.18 (1)			
J-K	-1684.0	-91.8	-91.8	0.04 (1)			
K-L	-1684.0	-91.8	-91.8	0.03 (1)			
L-M	-1684.0	-91.8	-91.8	0.21 (1)			
M-N	-1684.0	-91.8	-91.8	0.21 (1)			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
G	1-0-12	-178	-178	---	TOP	VERT	TOTAL	---	C1
H	1-11-4	-541	-541	---	TOP	VERT	TOTAL	---	C1
I	3-11-4	-436	-436	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 089-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/300 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.30/1.00 (A-B:1), BC=0.21/1.00 (D-E:1), WB=0.22/1.00 (A-E:1), SS=0.27/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	818 354	1667 788	1987 1655

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.63 (A) (INPUT = 0.90)
JSI METAL = 0.21 (C) (INPUT = 1.00)

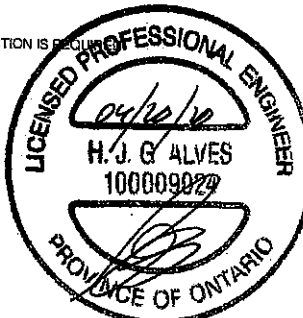


Structural component only
DWG# T-2006420

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408204	J1	3	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 07:47:37 2020 Page 1
ID:9ZM6hLI4ow3EYgKltJWHCzIHzo-T77ZnvpPqF_XDvQV1K4a5OKjn8d2hKDTIONRhzPuOa

Scale = 1:13.4

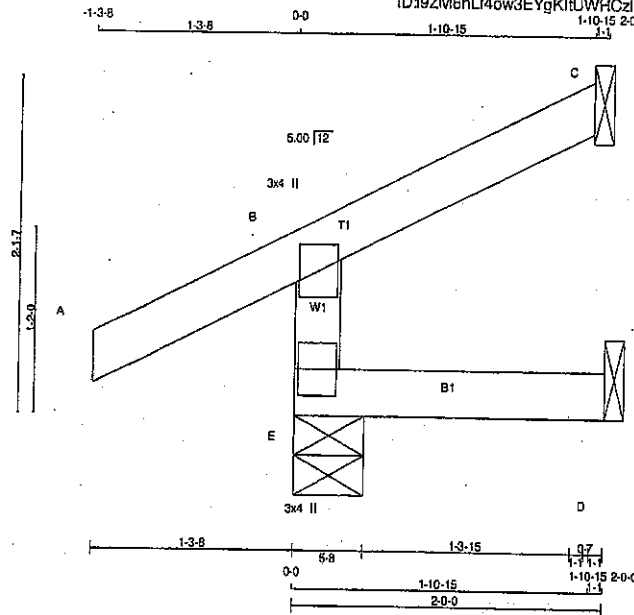

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	No.2
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BHG	REQD BHG
	VERT	HORZ	DOWN	HORZ
E	254	0	254	0
C	66	0	66	0
D	16	0	16	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	177	130 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0
C	46	37 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
D	13	0 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. VERT. LOAD (LC1)	MAX. HORZ. LOAD (LC1)	MAX. UNBRACED LENGTH (FR-TO)	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. VERT. LOAD (LC1)
FR-TO										
E-B		-234 / 0	0.0	0.0	0.01 (4)	7.81				
A-B		0 / 29	-91.8	-91.8	0.12 (1)	10.00				
B-C		-10 / 0	-91.8	-91.8	0.06 (1)	10.00				
E-D		0 / 0	-18.5	-18.5	0.02 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8 PSF
DL = 6.0 PSF	
SOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.5 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS=0.00/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MAX	MIN	MAX	MIN
MT20	618	354	1687
	788	1987	1556

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)

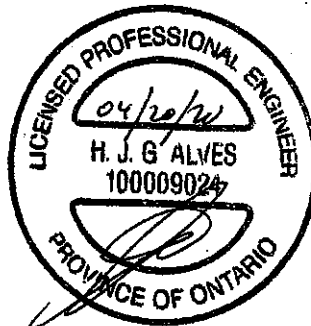

Structural component only
DWG# T-2006370

JOB NAME 408204	TRUSS NAME J2	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2018 Mitek Industries, Inc. Fri Apr 17 07:47:38 2020 Page 1
 ID:9ZM6hLI4ow3EYgKtUWHCzIHzo-xJhxFq1bZ6Cq2?hb1b5dbHsgYzHO7aNIxIw_7zPuOZ

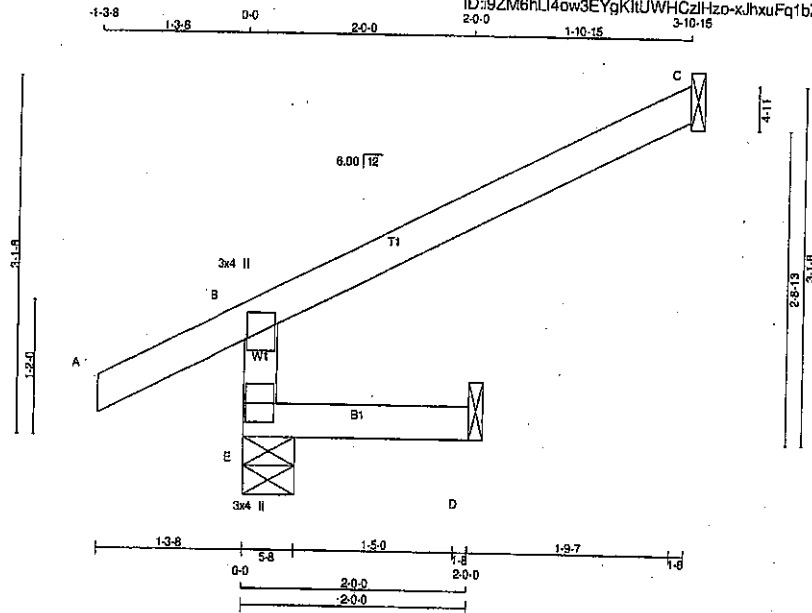

LUMBER

N.L.G.A. RULES	CHORDS	SIZE	DRY	No.2
E - B	2x4	DRY	No.2	
A - C	2x4	DRY	No.2	
E - D	2x4	DRY	No.2	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	REQD BRG IN-SX
E	369	369	5-8	5-8
C	135	135	1-8	1-8
D	16	16	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
E	256	194 / 0	0 / 0	0 / 0	0 / 0	62 / 0	0 / 0
C	93	75 / 0	0 / 0	0 / 0	0 / 0	18 / 0	0 / 0
D	13	0 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (5)

MEMB.	MAX. FACTORED FORCE (LBS)	CHORDS		WEBS		MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)
		VERT. LOAD (PLF)	LC1 MAX CS (LC)	MAX. UNBRACED LENGTH FR-TO	MAX. UNBRACED LENGTH FR-TO		
E-B	-349 / 0	0.0	0.0	0.01 (4)	7.81		
A-B	0 / 28	-91.8	-91.8	0.13 (5)	10.00		
B-C	-20 / 0	-91.8	-91.8	0.24 (1)	8.25		
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 10 = 30 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 38.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
 OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19')
 CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00')
 ALLOWABLE DEFL.(TL) = $L/360$ (0.19')
 CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00')

CSI: TC=0.24/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.15 (E) (INPUT = 0.90)
 JSI METAL= 0.10 (B) (INPUT = 1.00)




Structural component only
 DWG# T-2006371

JOB NAME 408204	TRUSS NAME J3	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 07:47:39 2020 Page 1
ID:39ZM6hLi4ow3EYgKtUWHCzIHzo-PVfJ6arMsEFSCat9i6KApo26yH7aqWwBVtWazPuOY
5-10-8

Scale = 1:13.4

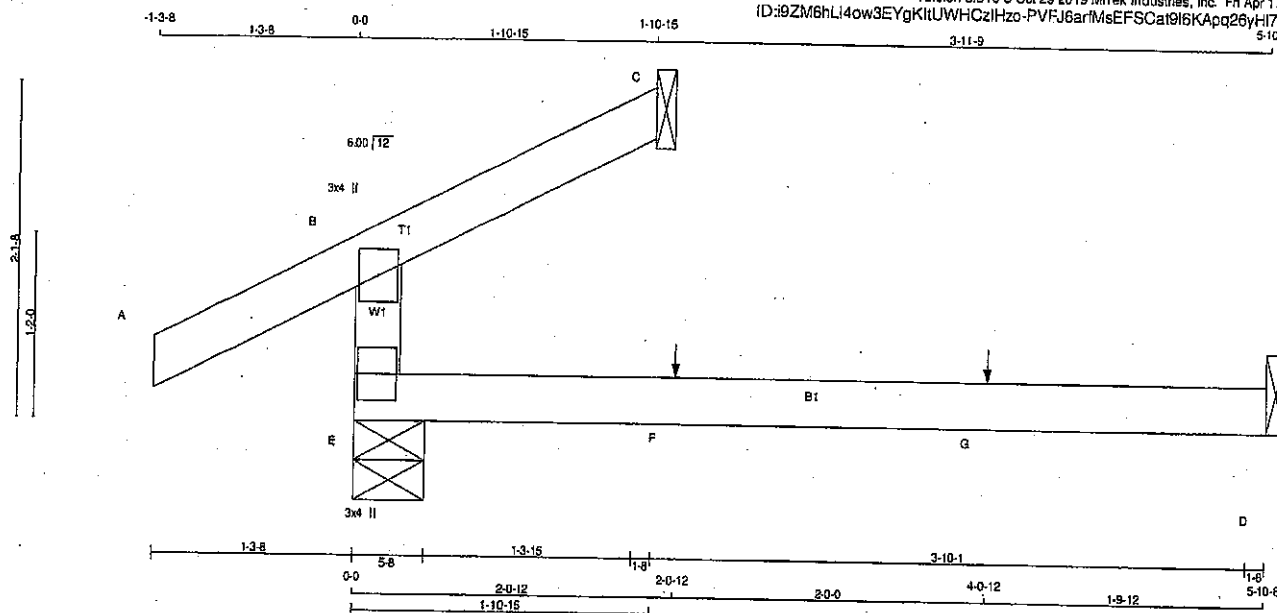

LUMBER

N.L.G.A. RULES
CHORDS SIZE
E - B 2x4 DRY
A - C 2x4 DRY
E - D 2x4 DRY

LUMBER
No.2
No.2
No.2

DESCR.
SPF
SPF
SPF

DRY, SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
E	297	0	297	0	5-8	5-8
C	66	0	66	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	212	130/0	0/0	0/0	0/0	82/0	0/0
C	48	37/0	0/0	0/0	0/0	9/0	0/0
D	36	0/0	0/0	0/0	0/0	36/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO				
E-B	-234/0	0.0	0.0	0.13 (4)
A-B	0/28	-91.8	-91.8	0.12 (1)
B-C	-10/0	-91.8	-91.8	0.06 (1)
E-F	0/0	-18.5	-18.5	0.13 (4)
F-G	0/0	-18.5	-18.5	0.13 (4)
G-D	0/0	-18.5	-18.5	0.13 (4)

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	2-0-12	1	1	---	BACK	VERT	TOTAL	---	C1
G	4-0-12	1	1	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 33.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CSI: TC=0.13/1.00 (B-E), BC=0.13/1.00 (D-E), WB=0.09/1.00 (n/a:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=0.99 NAIL=0.89 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)

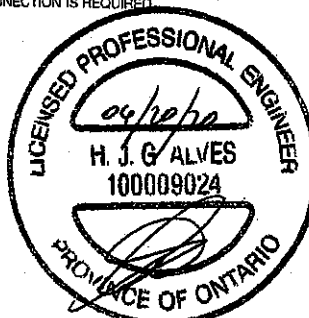

Structural component only
DWG# T-2006372

JOB NAME 408204	TRUSS NAME J4	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

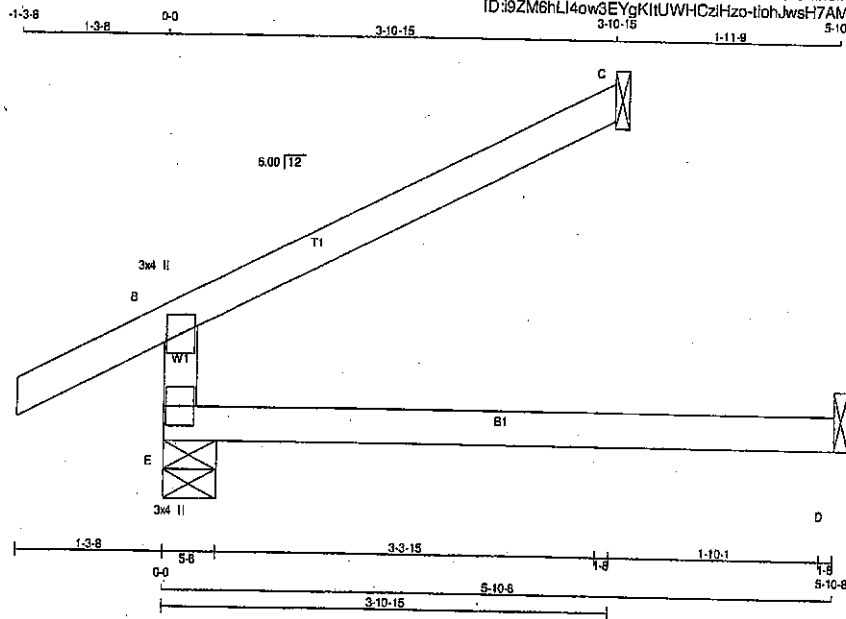

LUMBER

N. L. G. A. RULES

CHORDS SIZE

E - B 2x4 DRY No.2

A - C 2x4 DRY No.2

E - D 2x4 DRY No.2

DRY: SEASONED LUMBER.

LUMBER

DESCR.

SPF

SPF

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
E	412	412	0	0
C	135	135	0	0
D	45	50	0	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
E	291	194 / 0	0 / 0	0 / 0	97 / 0	0 / 0
C	93	75 / 0	0 / 0	0 / 0	18 / 0	0 / 0
D	38	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)
FR-TO									
E-B		-348 / 0	0.0	0.0	0.13 (4)	7.81			
A-B		0 / 28	-91.8	-91.8	0.12 (1)	10.00			
B-C		-20 / 0	-91.8	-91.8	0.24 (1)	6.25			
E-D		0 / 0	-18.5	-18.5	0.13 (4)	10.00			

TOTAL WEIGHT = 3 X 14 = 43 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

BOT CH. LL = 6.0 PSF

TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")

CALCULATED VERT. DEFL.(LL) = L/999 (0.00")

ALLOWABLE DEFL.(TL) = L/360 (0.20")

CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.24/1.00 (B-C:1), BC=0.13/1.00 (D-E:4),

WB=0.00/1.00 (n/a:0), SSI=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 618 354 1867 788 1967 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.15 (E) (INPUT = 0.80)

JSI METAL= 0.10 (B) (INPUT = 1.00)

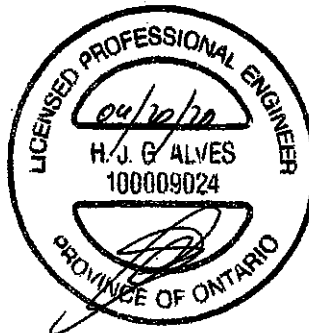


Structural component only
DWG# T-2006373

JOB NAME 408204	TRUSS NAME J5	QUANTITY 9	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 07:47:41 2020 Page 1
ID:19ZM6hLI4ow3EYgKIUWHCzIHzo-LuM4XGsvuUyWkGGA8oFEVdMyDbUUpOV_aaSzPuOW

Scale = 1:22.5

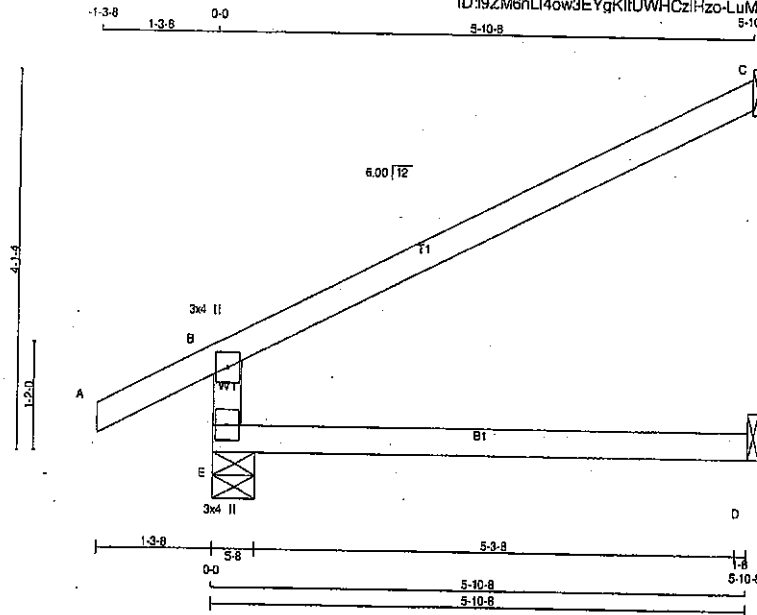

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
E - B	2x4	DRY No.2
A - C	2x4	DRY No.2
E - D	2x4	DRY No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	525	0	525	0	0	5-8	5-8
C	202	0	202	0	0	1-8	1-8
D	45	0	50	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	369	257.0	0.0	0.0	0.0	111.0	0.0
C	139	113.0	0.0	0.0	0.0	26.0	0.0
D	36	0.0	0.0	0.0	0.0	36.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED HORIZ. LOAD (LC2)	MAX. FACTORED UNBRACED LENGTH (FR-TO)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LC2)
E-B		-461.0	0.0	0.0	0.13 (4)	7.81			
A-B		0.28	-91.8	-91.8	0.12 (1)	10.00			
B-C		-30.0	-91.8	-91.8	0.54 (1)	6.25			
E-D		0.0	-18.5	-18.5	0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (N/A:0), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1887 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (E) (INPUT = 0.90)
JSI METAL = 0.13 (B) (INPUT = 1.00)

Structural component only
DWG# T-2006374



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC	DRWG NO.
408204	J6	6	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 9 Oct 29 2018 Mitek Industries, Inc. Fri Apr 17 07:47:42 2020 Page 1					
ID:9ZM6hL14ow3EYgKtUWHCzHzo-q4wSkctYfncpJgUsqg1oRFXK9JDKXZzc9J87uzPuOV					
Scale = 1:27.0					

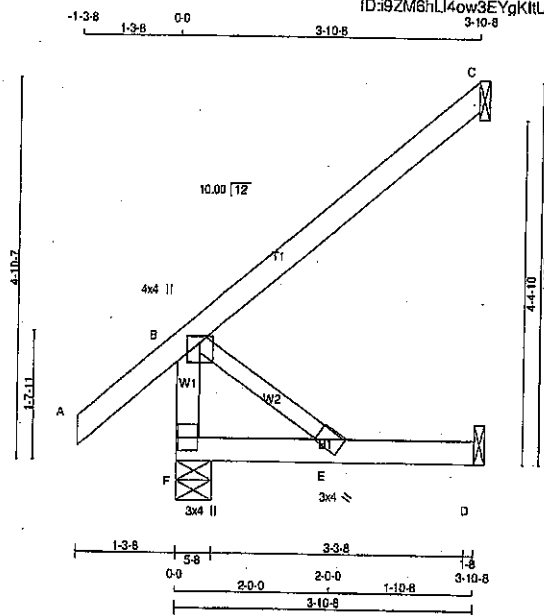

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY
DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
E BMV+w	MT20	3.0	4.0		
F BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	DOWN	IN-SX	IN-SX
F	341	341	5-8	5-8
C	178	178	1-8	1-8
D	36	40	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE	SNOW	LIVE	PERM	LIVE	WIND	DEAD	SOIL
JT COMBINED							
F	239	170 / 0	0 / 0	0 / 0	0 / 0	58 / 0	0 / 0
C	122	99 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0
D	29	0 / 0	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)
FR-TO								
F-B	-305 / 0	0.0	0.0	0.03 (1)	7.81	B-E	0 / 0	0.00 (1)
A-B	0 / 41	-91.8	-91.8	0.14 (5)	10.00			
B-C	0 / 0	-91.8	-91.8	0.23 (1)	10.00			
F-E	0 / 0	-18.5	-18.5	0.08 (4)	10.00			
E-D	0 / 0	-18.5	-18.5	0.08 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.01")

CSI: TC=0.23/1.00 (B-C:1), BC=0.08/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1657 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.24 (B) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)

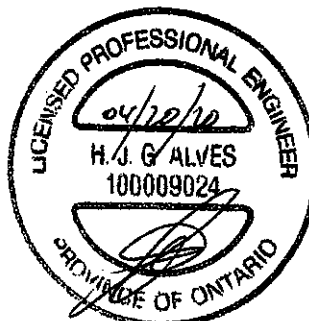

Structural component only
DWG# T-2006375

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408205	J21	5	1	GREEN PARK HOMES	
Tamarack Pool Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 07:52:04 2020 Page 1					
ID:J9ZM6hLi4ow3EYgKiUWHCzIHzo-9Uiv/C2uyHdelxKpAvMTPhLlnIWjRQXswB?JjzPuKp					
Scale = 1:18.0					

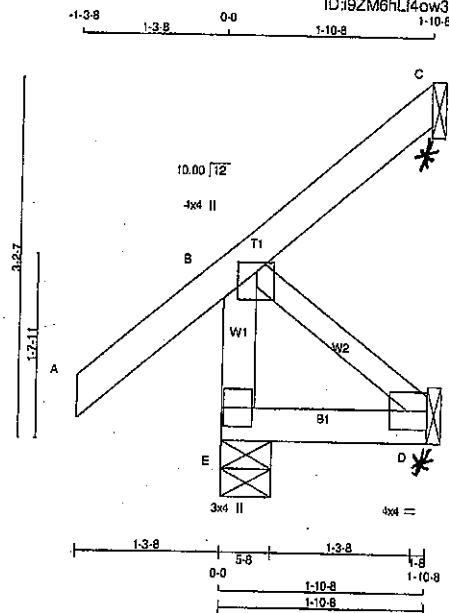

LUMBER			
N. L. G. A. RULES	SIZE	DRY	No.2
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
D	BMV1-i	MT20	4.0	4.0	2.00 Edge
E	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT	DOWN	UP	IN-SX
E	277	0	5-8
C	39	0	1-8
D	17	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LOASE	MAX./MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	192	145/0	0/0	0/0	0/0	47/0	0/0	0/0
C	27	22/-26	0/0	0/0	0/0	5/0	0/0	0/0
D	13	0/0	0/0	0/0	0/0	13/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	UNBRAC LENGTH FR-TO
FR-TO							
E-B	-260/0	0.0	0.0 0.03 (1)	7.81	B-D	0/0	0.00 (1)
A-B	0/41	-91.8	-91.8 0.13 (1)	10.00			
B-C	-30/0	-91.8	-91.8 0.12 (1)	6.25			
E-D	0/0	-18.5	-18.5 0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 085-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.13/1.00 (A-B:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (B-D:1), SSI=0.08/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1667
	788	1937	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.20 (B) (INPUT = 0.50)
JSI METAL = 0.05 (B) (INPUT = 1.00)

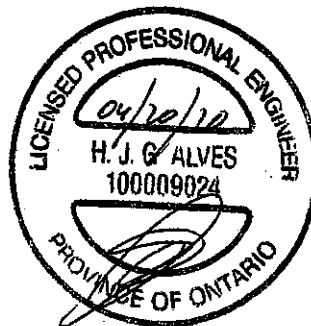


Structural component only
DWG# T-2006395

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408205	J22	5	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 07:52:06 2020 Page 1

D:\9ZM6hL4ow3EYgKitUWHCzIH2o-5tF8t48UvIM_EUCJUPxU6Ng7aRIBLwqKEg6ObzPuKN

Scale = 1:25.0

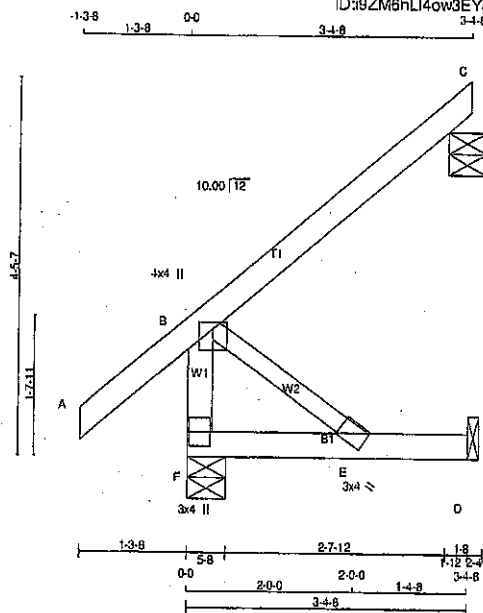

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	No.2
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2

ALL WEBS 2x3 DRY, SEASONED LUMBER.

LUMBER

DESCR.	SPF
SPF	SPF
SPF	SPF

DESCR.

SPF	SPF
SPF	SPF
SPF	SPF

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
E	BMV+w	MT20	3.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	REQD BRG IN-SX
F	313 0	313 0	5-8	5-8
C	155 0	155 0	5-8 (3-4)	5-8
D	31 0	35 0	1-8	1-8

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

SEE MITEK STANDARD DETAIL 997791H FOR CONNECTION TO JOINT(S) D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	218	157 / 0	0 / 0	0 / 0	0 / 0	0 / 0	62 / 0	0 / 0
C	107	88 / 0	0 / 0	0 / 0	0 / 0	0 / 0	20 / 0	0 / 0
D	25	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	25 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
F-B	-282 / 0	B-E	0 / 0
A-B	0 / 41		
B-C	0 / 0		
F-E	0 / 0		
E-D	0 / 0		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 5 X 14 = 71 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.18")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.18")
CALCULATED VERT. DEFL. (TL) = L/999 (0.01")

CSI: TC=0.18/1.00 (B-C:1), BC=0.09/1.00 (E-F:4),
WB=0.00/1.00 (B-E:1), SS=0.09/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1667 788

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.22 (B) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)

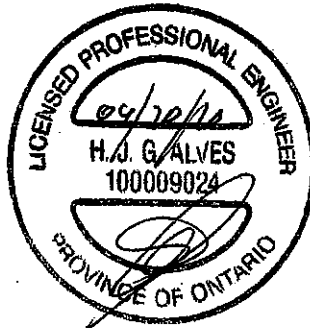

Structural component only
DWG# T-2006396

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408205	J23	5	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

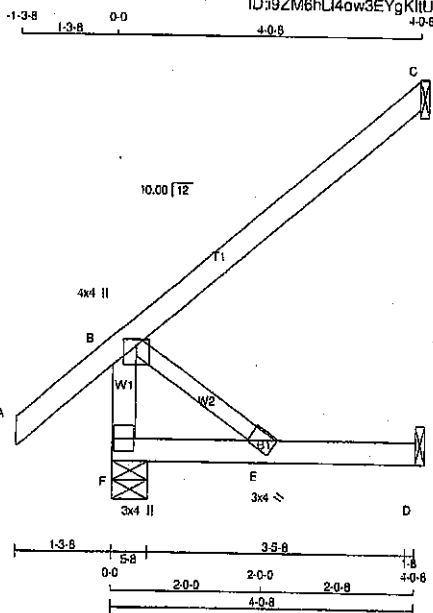

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 07:52:07 2020 Page 1
ID:J9ZM6hU4ow3EYgKIUWHCzIHzo-Z3RdMD4mFC?DcO3Or1wA1KwqY_m6woAzYuQw1zPuKM
Scale = 1:27.7

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	SPF
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY, SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	IMVW+p	MT20	4.0	4.0	1.00 2.00
E	BMW+w	MT20	3.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORIZ	GROSS REACTION	HORIZ	BRG	IN-SX	BRG	IN-SX
F	350	0	350	0	0	5-8	5-8	5-8	5-8
C	185	0	185	0	0	1-8	1-8	1-8	1-8
D	37	0	42	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST LCASE		MAX/MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
F	245	174.0	0.0	0.0	0.0
C	128	103.0	0.0	0.0	0.0
D	30	0.0	0.0	0.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)	MAX	CS1 (LC)
FR-TO		FROM	TO	FR-TO			
F-B	-312 / 0	0.0	0.0 0.03 (1)	7.81	0.0	0.00 (1)	
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00			
B-C	0 / 0	-91.8	-91.8 0.25 (1)	10.00			
F-E	0 / 0	-18.5	-18.5 0.09 (4)	10.00			
E-D	0 / 0	-18.5	-18.5 0.09 (4)	10.00			

TOTAL WEIGHT = 5 X 15 = 80 lb

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015
THIS DESIGN COMPLIES WITH:
- PART 8 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPI 2011, TPI 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.25/1.00 (B-C:1), BC=0.09/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSR=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(P.S.I.) (P.L.I.) (P.L.I.)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1657 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.24 (B) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006397

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408206	J31	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2018 MiTek Industries, Inc. Fri Apr 17 08:01:33 2020 Page 1					
ID:1KkO77G518KLXoXQOnZrb?zIFJT- yec8mxoy6JvWNKA?y4vzhMZc8yNYnHHiyXcnEzPu8W					
2-10-8					

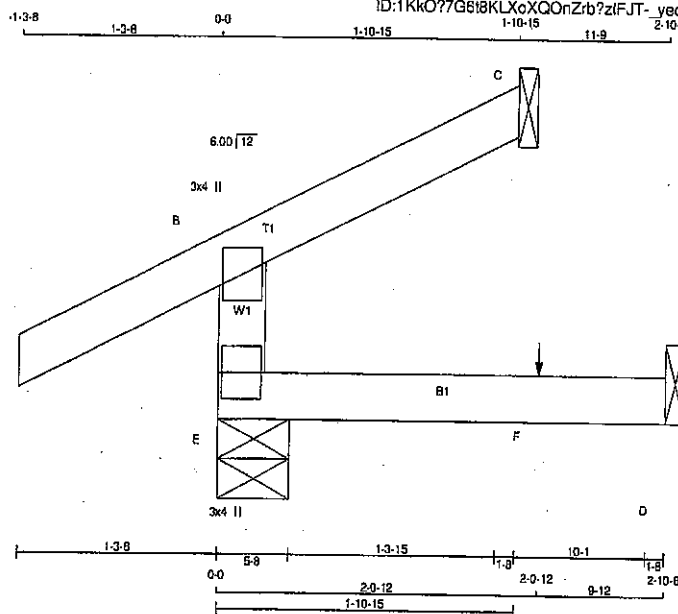

LUMBER

N. L. G. A. RULES	
CHORDS	SIZE
E - B	2x4 DRY No.2
A - C	2x4 DRY No.2
E - D	2x4 DRY No.2

DRY, SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
E	284	0	264	0	0	5-8	5-8	
C	66	0	66	0	0	1-8	1-8	
D	23	0	26	0	0	1-8	1-8	

SEE MITTEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	185	130 / 0	0 / 0	0 / 0	0 / 0	55 / 0	0 / 0
C	46	37 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
D	18	0 / 0	0 / 0	0 / 0	0 / 0	18 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	FR-TO	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. FACTORED CSI (LC)	MAX. UNBRACED LENGTH FR-TO	MEMB.	FR-TO	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
E-B	-234 / 0	0.0	0.0	0.02 (4)	7.81	A-B	0 / 28	-91.8	-91.8 0.13 (5)
A-B	0 / 28	-91.8	-91.8	0.06 (1)	10.00	B-C	-10 / 0	-91.8	-91.8 0.06 (1)
B-C	-10 / 0	-91.8	-91.8	0.06 (1)	10.00	E-F	0 / 0	-18.5	-18.5 0.03 (4)
E-F	0 / 0	-18.5	-18.5	0.03 (4)	10.00	F-D	0 / 0	-18.5	-18.5 0.03 (4)

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	2-0-12	1	1	1	BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 8 = 17 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

DESIGN ASSUMPTIONS

- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.13/1.00 (A-B:5), BC=0.03/1.00 (D-E:4), WS=0.00/1.00 (n/a:0), SSI=0.10/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	618	354
	1667	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

SI GRIP= 0.10 (E) (INPUT = 0.90)
SI METAL= 0.06 (B) (INPUT = 1.00)

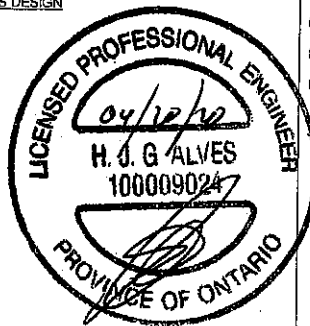


Structural component only
DWG# T-2006405

JOB NAME 408206	TRUSS NAME J32	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:01:34 2020 Page 1

ID:1KkO77G618KLXoXQOnZrb?ziFJT-S8C_M5yQjQrm7XvMZcb8WuvkQYicHEXQxcG9KgZPuBV

Scale = 1:15.7

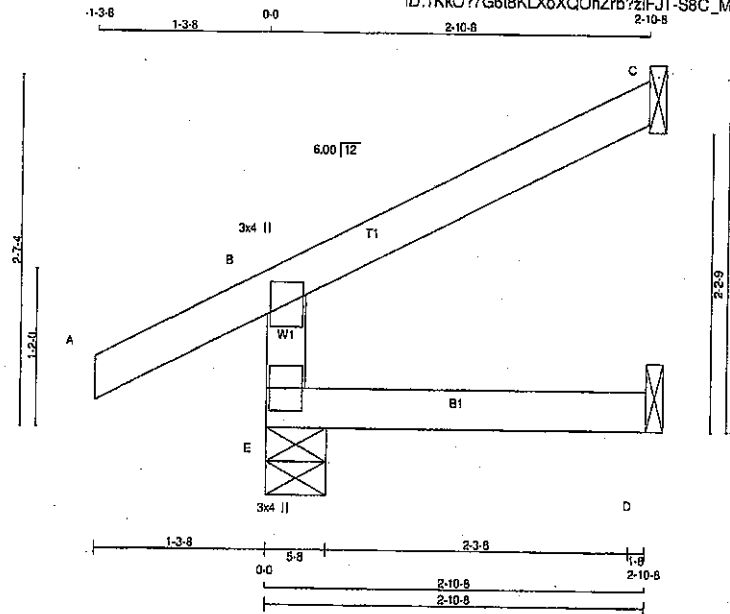

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV4p	MT20	3.0	4.0	
E	SMV14p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
E	319	0	319	0	5-8	5-8
C	99	0	99	0	1-8	1-8
D	23	0	26	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

MAX/MIN. COMPONENT REACTIONS							
JT	1ST LOASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	229	161.0	0.0	0.0	0.0	62.0	0.0
C	88	55.0	0.0	0.0	0.0	13.0	0.0
D	18	0.0	0.0	0.0	0.0	18.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	MAX. FACTORED FORCE (LBS)	CHORDS		WEBS	
		FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (LC)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LC)
FR-TO		FROM	TO	LENGTH	FR-TO
E-B	-289.0	0.0	0.0	0.02 (4)	7.81
A-B	0.28	-91.8	-91.8	0.13 (5)	10.00
B-C	-15.0	-91.8	-91.8	0.13 (1)	6.25
E-D	0.0	-18.5	-18.5	0.03 (4)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 10 = 29 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.8	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.13/1.00 (B-C:1), BC=0.03/1.00 (D-E:4), WB=0.00/1.00 (W:30), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.12 (E) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006406

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408206	J33	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:01:35 2020 Page 1
ID:1KKO77G6I8KLXoXQOnZrb7zIFJT-xLIMZRY2UKZdihUY7J6N26Rv3yeS0hna9G0js6zPuBU

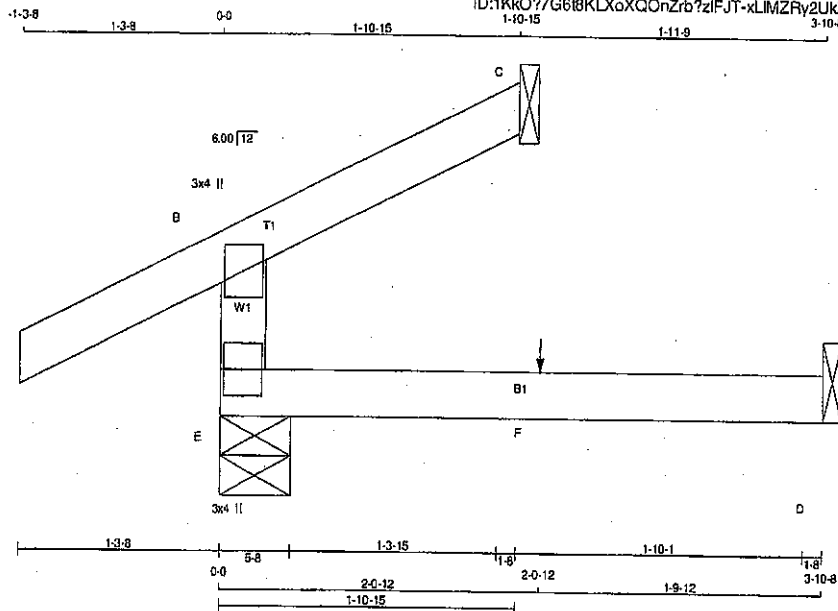

Scale = 1:13.4

LUMBER

N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
E - D	2x4 DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
E BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	RECORD BRG IN-SX
JT	VERT	HORZ	DOWN	HORZ
E	275	0	275	0
C	86	0	86	0
D	30	0	34	0

SEE MITEK STANDARD DETAIL B87791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LOASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	194	130	0	0	0	64	0
C	48	37	0	0	0	9	0
D	24	0	0	0	0	24	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LOAD LC1 (LBS)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH FR-TO	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO								
E-B	-234	0	0	0.05 (4)	7.81			
A-B	9	28	-91.8	0.14 (5)	10.00			
B-C	-10	0	-91.8	0.06 (1)	10.00			
E-F	0	0	-18.5	0.08 (4)	10.00			
F-D	0	0	-18.5	0.06 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	2-0-12	1	1	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
DL	=	6.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.01")

CSI: TC=0.14/1.00 (A-B-5), BC=0.06/1.00 (D-E-4), WB=0.00/1.00 (n/a:0), SS1=0.10/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR SECTION (PSI)	(PL)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1867

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006407

JOB NAME 408206	TRUSS NAME J34	QUANTITY 9	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 17 08:01:36 2020 Page 1
ID:1KkO77G6i8KLXoXQOnZrb?zIFJT-PXJknzgF1hUNg3h1dcbJ_3HMzh81jOwiGOZzPuBT

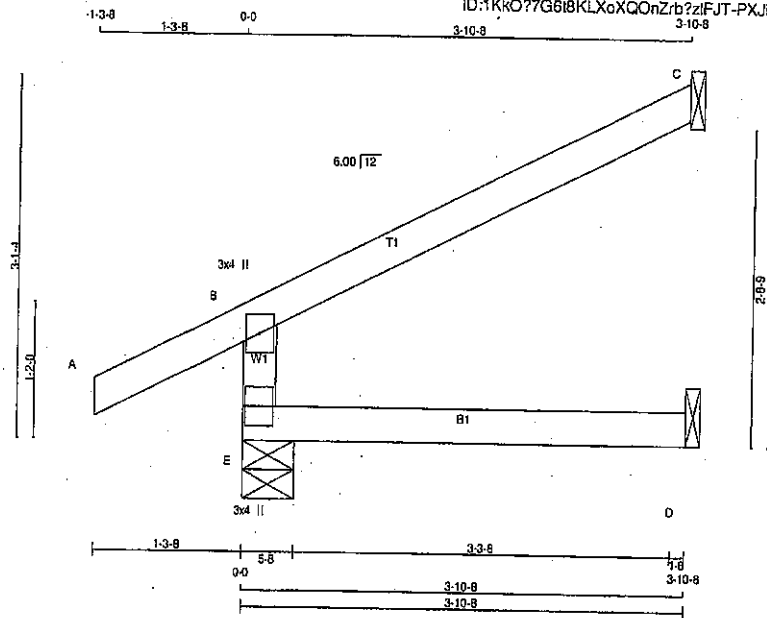

Scale = 1:18

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2	
A - C	2x4	DRY	No.2	
E - D	2x4	DRY	No.2	

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
E BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECORD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	388	0	388	0	5-8	5-8
C	133	0	133	0	1-8	1-8
D	30	0	34	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN COMPONENT REACTIONS				WIND	DEAD	SOIL
		SNOW	LIVE	PERM. LIVE	UNBRAC			
E	272	193 / 0	0 / 0	0 / 0	0 / 0	78 / 0	0 / 0	0 / 0
C	92	74 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0	0 / 0
D	24	0 / 0	0 / 0	0 / 0	0 / 0	24 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (LBS)	MAX. UNBRAC (LBS)	MEMB.	FORCE (LBS)	MAX. (LBS)
FR-TO		FROM TO	CSI (LC)	LENGTH	FR-TO		CSI (LC)
E-B	-347 / 0	0.0	0.0 (5) (4)	7.81			
A-B	0 / 28	-91.8	-91.8 0.14 (5)	10.00			
B-C	-20 / 0	-91.8	-91.8 0.23 (1)	6.25			
E-D	0 / 0	-18.5	-18.5 0.08 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 9 X 12 = 108 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.01")

CSI: TC=0.23/1.00 (B-C:1), BC=0.06/1.00 (D-E:4),
WB=0.00/1.00 (N/A:0), SSI=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1657 789	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.15 (E) (INPUT = 0.90)
JSI METAL=0.10 (B) (INPUT = 1.00)

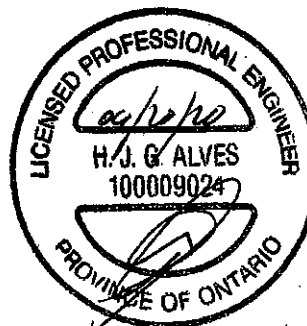

Structural component only
DWG# T-2006408

LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.




Double-Shear
Nailing
Top View




Double-Shear
Nailing
Side View;
Do not
bend tab




Dome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,680

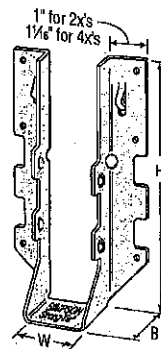


✓ LUS28

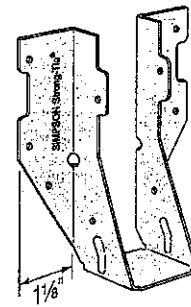


LU26L

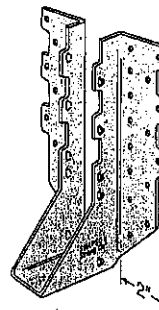


✓ HUS210
(HUS26, HUS28,
and HHUS similar)

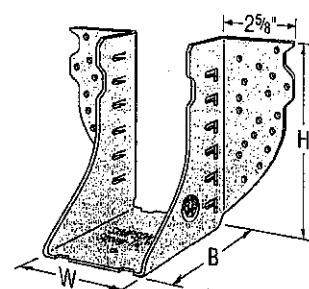

✓ HGUS28-2




✓ HHUS210-2

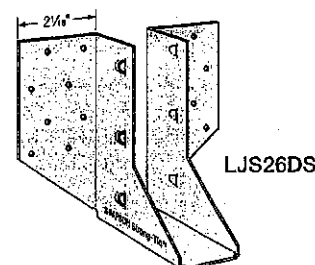

LJS26DS

**Typical HUS28
Installation
with Reduced
Heel Height**
*(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)*

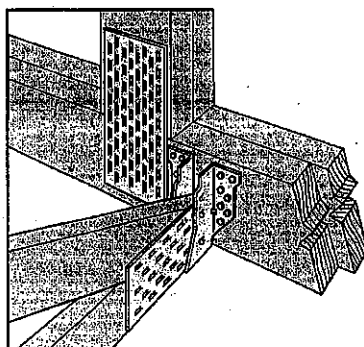

LUL/LUS/LJS/HUS/HHUS/HGUS

HHUS/HGUS

See Hanger Options information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value

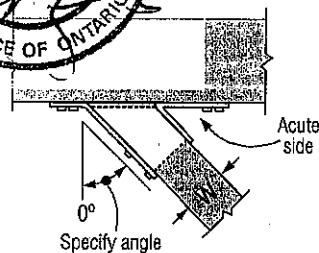

Top View HHUS Hanger
Skewed Right
(joist must be bevel cut)
All joist nails installed on the
outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance				
		W	H	B	d _g ³	Header	Joist	D-Fir-L		S-P-F		
								Uplift	Normal	Uplift	Normal	
								(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)	
								lb.	lb.	lb.	lb.	
								kN	kN	kN	kN	
Single 2x Sizes												
■	LUS24	18	1 1/8	3 1/2	1 1/4	2 1/4	(4) 10d	(2) 10d	710	1625	645	1155
									3.16	7.23	2.87	5.14
■	LU24L	22	1 1/8	3	1 1/4	2 1/4	(4) 10d	(2) 10d x 1 1/2"	360	1020	320	725
									1.60	4.54	1.42	3.22
■	LU26L	22	1 1/8	5	1 1/4	4 1/4	(6) 10d	(4) 10d x 1 1/2"	720	1605	645	1140
									3.20	7.14	2.87	5.07
SS	LUS26	18	1 1/8	4 1/4	1 1/4	3 3/4	(4) 10d	(4) 10d	1420	2170	1290	1630
									6.32	9.65	5.74	7.25
■	HUS26	16	1 1/8	5 1/4	3	3 1/4	(14) 16d	(6) 16d	2705	4940	2065	3875
									11.30	21.97	9.20	17.24
■	LJS26DS	18	1 1/8	5	3 1/2	4 1/4	(16) 16d	(6) 16d	2055	4265	1460	4115
									9.14	18.97	6.49	18.31
■	HGUS26	12	1 1/8	5 1/4	5	4 1/4	(20) 16d	(8) 16d	2685	6625	2685	5700
									11.96	29.51	11.96	25.35
■	LU28L	20	1 1/8	6 1/4	1 1/4	5 1/4	(8) 10d	(6) 10d x 1 1/2"	1140	2185	1020	1550
									5.07	9.72	4.54	6.89
SS	LUS28	18	1 1/8	6 1/4	1 1/4	3 3/4	(6) 10d	(4) 10d	1420	2520	1290	1790
									6.32	11.21	5.74	7.96
■	HUS28	16	1 1/8	7 1/4	3	6 1/4	(22) 16d	(8) 16d	3605	5365	2675	4345
									16.04	23.86	11.90	19.33
■	HGUS28	12	1 1/8	7 1/4	5	6 1/4	(36) 16d	(12) 16d	3310	7675	3310	6900
									14.74	34.19	14.74	30.73
■	LU210L	20	1 1/8	8	1 1/4	7 1/4	(10) 10d	(6) 10d x 1 1/2"	1140	2495	1020	1770
									5.07	11.10	4.54	7.87
SS	LUS210	18	1 1/8	7 1/4	1 1/4	3 3/4	(8) 10d	(4) 10d	1420	2785	1290	2210
									6.32	12.39	5.74	9.83

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.

2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.

3. d_g is the distance from the bearing seat to the top joist nail.

4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.


5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _e ³	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb.	(K _D = 1.00) lb.	(K _D = 1.15) lb.	(K _D = 1.00) lb.
kN											
Double 2x Sizes											
LUS24-2	18	3 1/8	3 1/8	2	1 1/2	(4) 16d	(2) 16d	835	2020	590	1435
LUS26-2	18	3 1/8	4 1/8	2	4	(4) 16d	(4) 16d	3.71	8.99	2.62	6.38
								1720	2595	1545	1920
HHUS26-2	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	7.65	11.54	6.87	8.54
								2850	7335	2065	5205
HGUS26-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	12.68	32.63	9.20	23.15
								4385	8950	3110	6355
LUS28-2	18	3 1/8	7	2	4	(6) 16d	(4) 16d	19.51	39.81	13.83	28.27
								1720	3325	1545	2575
HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	7.65	14.79	6.87	11.45
								3765	8940	2675	6345
HGUS28-2	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	16.75	39.77	11.90	28.22
								6070	12980	4310	9215
LUS210-2	18	3 1/8	9	2	6	(8) 16d	(6) 16d	27.00	57.74	19.17	40.99
								2580	4500	2320	3195
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d	11.48	20.02	10.32	14.21
								4670	9660	4235	7000
HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	20.77	42.97	18.84	31.14
								6840	14015	4855	10270
								30.43	62.34	21.60	45.69
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/2	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-3	12	4 1/8	7 1/4	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	4670	9670	4235	6865
								20.77	43.02	18.84	30.54
HGUS210-3	12	4 1/8	9 1/4	4	8 3/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
Quadruple 2x Sizes											
HGUS26-4	12	6 1/8	5 3/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-4	12	6 1/8	7 3/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-4	14	6 1/8	8 3/8	3	7 1/8	(30) 16d	(10) 16d	4670	10155	4235	7210
								20.77	45.17	18.84	32.07
HGUS210-4	12	6 1/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
HGUS212-4	12	6 1/8	10 3/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10645
								33.98	66.70	24.13	47.35
HGUS214-4	12	6 1/8	12 3/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80
4x Sizes											
LUS46	18	3 3/8	4 3/8	2	3 3/8	(4) 16d	(4) 16d	1720	2595	1545	1920
								7.65	11.54	6.87	8.54
HHUS46	14	3 3/8	5 1/4	3	3 1/8	(14) 16d	(6) 16d	2540	7335	2065	5205
								11.30	32.63	9.20	23.15
HGUS46	12	3 3/8	5 1/4	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
LUS48	18	3 3/8	6 3/8	2	3 3/8	(6) 16d	(4) 16d	1720	3325	1545	2575
								7.65	14.79	6.87	11.45
HHUS48	14	3 3/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765	8940	2675	6345
								16.75	39.77	11.90	28.22
HGUS48	12	3 3/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
LUS410	18	3 3/8	8 3/8	2	5 3/8	(8) 16d	(6) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HGUS410	12	3 3/8	9	4	8 3/8	(46) 16d	(16) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
HGUS412	12	3 3/8	10 3/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10645
								33.98	66.70	24.13	47.35
HGUS414	12	3 3/8	12 3/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80



Plated Truss Connectors

See footnotes
on p. 258.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

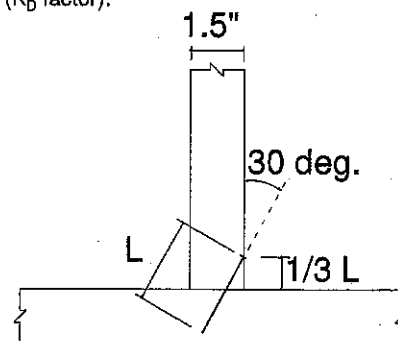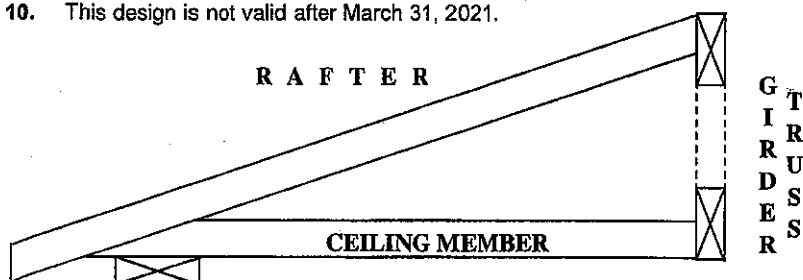

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019

BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

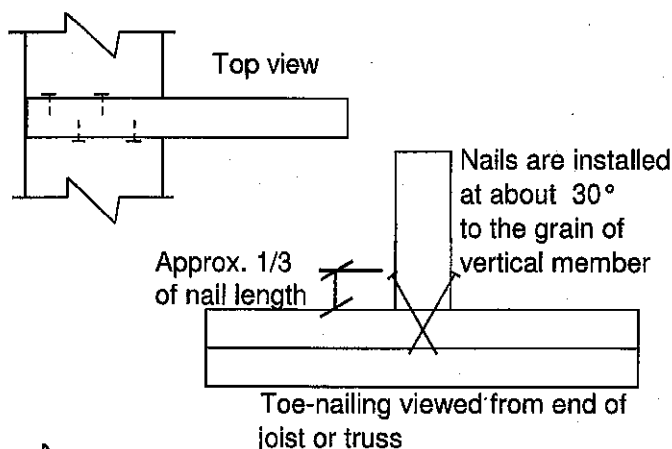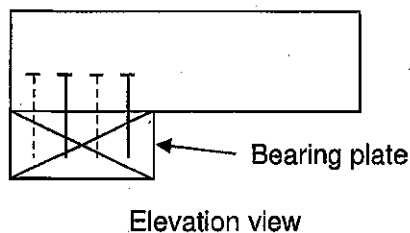

Toe-nailing on 2x4 Bearing Plate

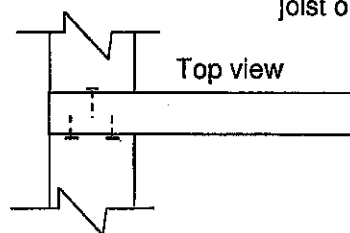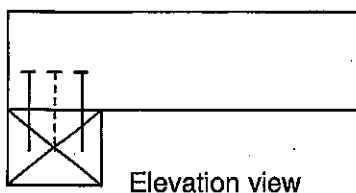

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7


December 2, 2019

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

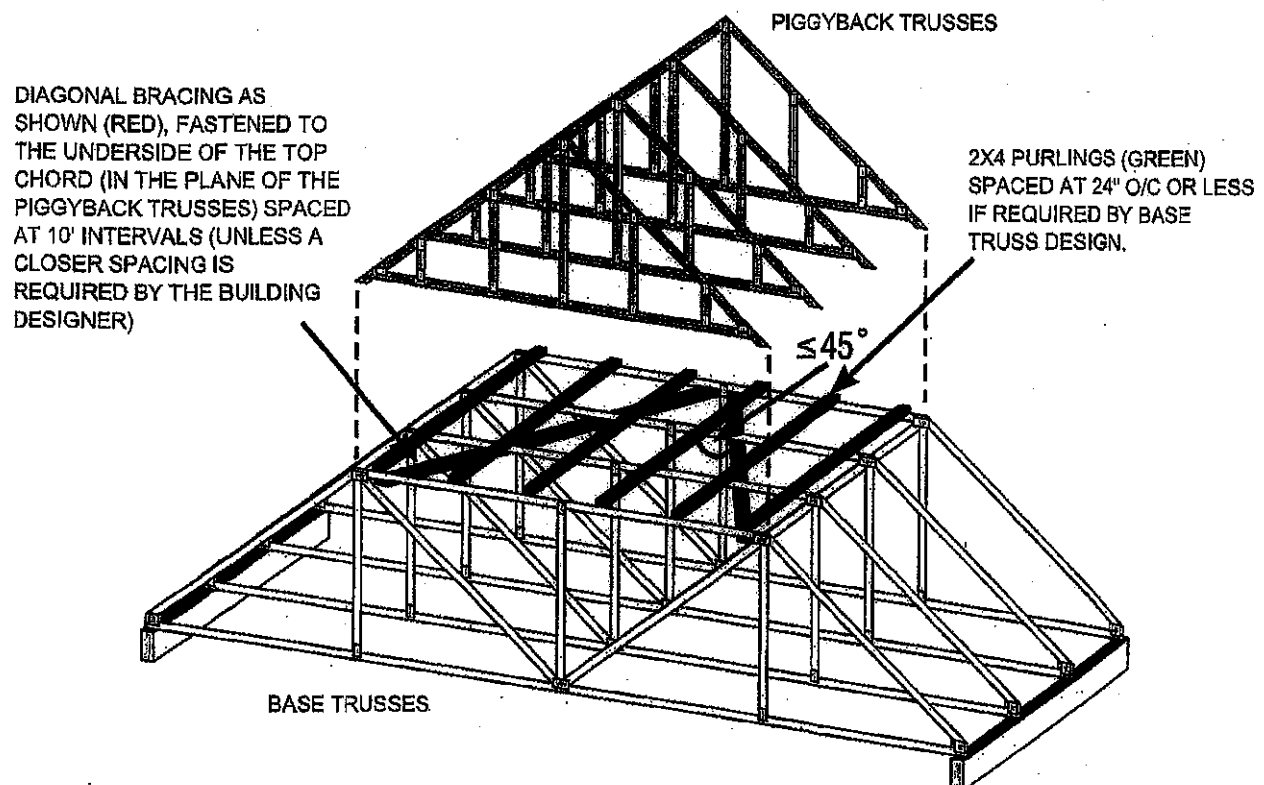


Disclaimer:


OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/8" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.

Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

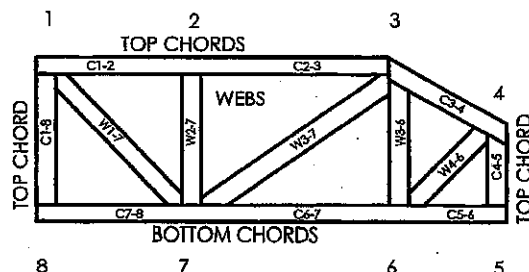

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MII-7473C rev. 10-'08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1900218

Feb 09, 2018