


FROM PLAN DATED:  
BUILDER: GREENPARK HOMES  
SITE: RUSSELL GARDEN S PH 3  
MODEL: MOUNTAINASH 5  
ELEVATION: 1  
LOT: 16  
CITY: WATERDOWN  
SALESMAN: MARIO DICIANO  
DESIGNER: AJ  
REVISION:

NOTES:  
REFER TO THE **NORDIC INSTALLATION** GUIDE FOR PROPER STORAGE AND INSTALLATION.  
**SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING CANT' OVER BRICK REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7, TABLES 1 & 2. **CERAMIC TILE** APPLICATION AS PER O.B.C 9.30.6.

LOADING:  
DESIGN LOADS: L/480.000  
LIVE LOAD: 40.0 lb/ft²  
DEAD LOAD: 20.0 lb/ft²  
SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 2020-09-04  
1st FLOOR

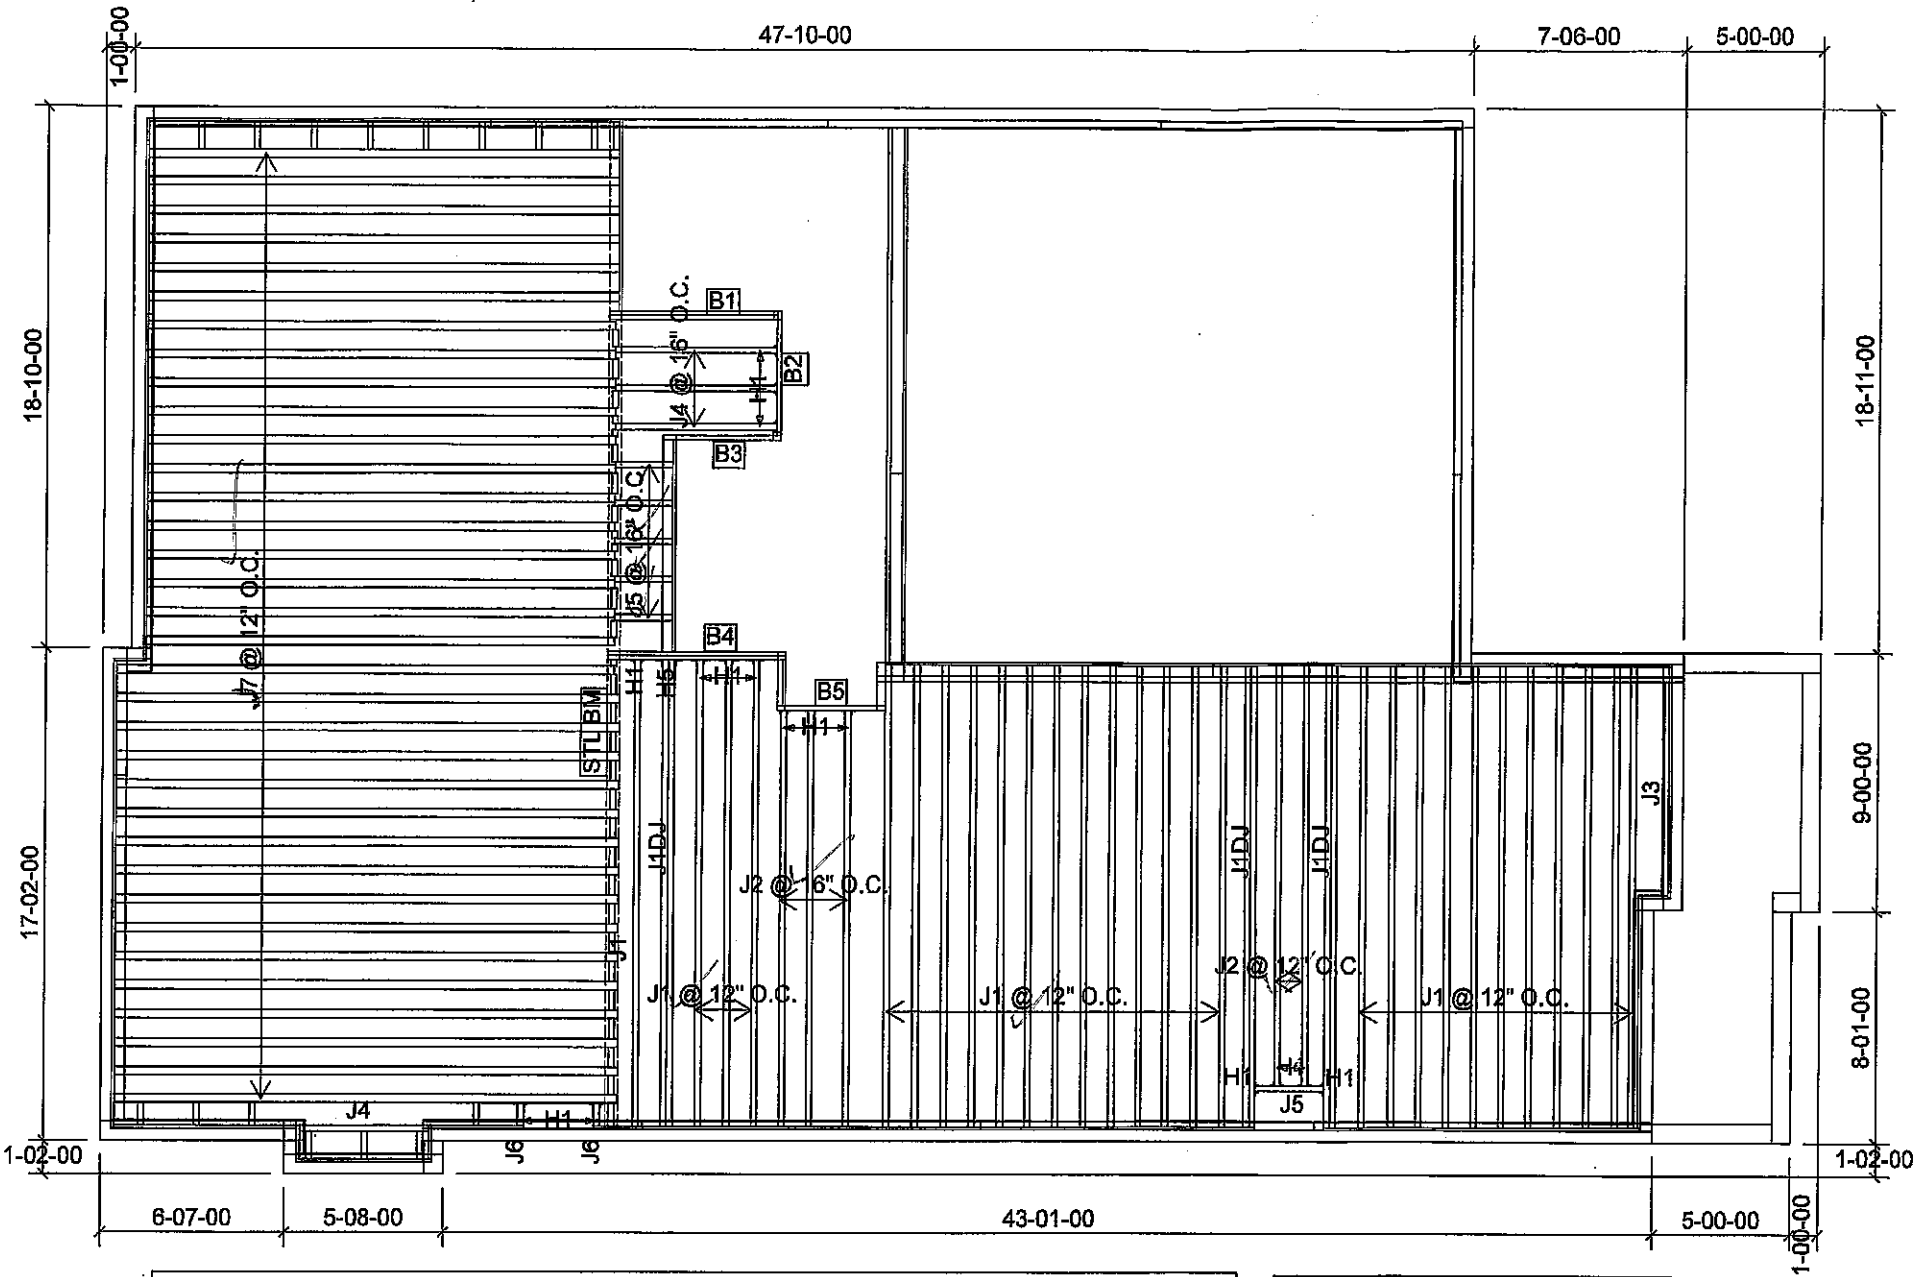

CITY OF HAMILTON  
Building Division

Permit No. 20-199448

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE  
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH  
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAWS  
These drawings and/or specifications have been reviewed by  
09/15/20  
FOR CHIEF BUILDING OFFICIAL

Products				
PlotID	Length	Product	Plies	Net Qty
J1	18-00-00	9 1/2" NI-40x	1	28
J1DJ	18-00-00	9 1/2" NI-40x	2	6
J2	16-00-00	9 1/2" NI-40x	1	5
J3	8-00-00	9 1/2" NI-40x	1	1
J4	6-00-00	9 1/2" NI-40x	1	4
J5	4-00-00	9 1/2" NI-40x	1	6
J6	2-00-00	9 1/2" NI-40x	1	2
J7	18-00-00	9 1/2" NI-80	1	34
B4	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B2	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B3	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B1	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B5	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1

Connector Summary		
Qty	Manuf	Product
6	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
2	H1	IUS2.56/9.5
2	H1	IUS2.56/9.5
2	H1	IUS2.56/9.5
1	H5	HU312-2

DATE  
FOR CHIEF BUILDING OFFICIAL  
These drawings and/or specifications have been reviewed by  
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAWS  
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH  
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE  
Permit No. 20-199448  
Building Division  
CITY OF HAMILTON

FROM PLAN DATED:

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDEN S PH 3

MODEL: MOUNTAINASH 5

ELEVATION: 1

LOT: 16

CITY: WATERDOWN

SALESMAN: MARIO DICIANO

DESIGNER: AJ

REVISION:

NOTES:

REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

LOADING:

DESIGN LOADS: L/480.000


LIVE LOAD: 40.0 lb/ft<sup>2</sup>

DEAD LOAD: 20.0 lb/ft<sup>2</sup>

SUBFLOOR: 5/8" GLUED AND NAILED

DATE: 2020-11-24

2nd FLOOR

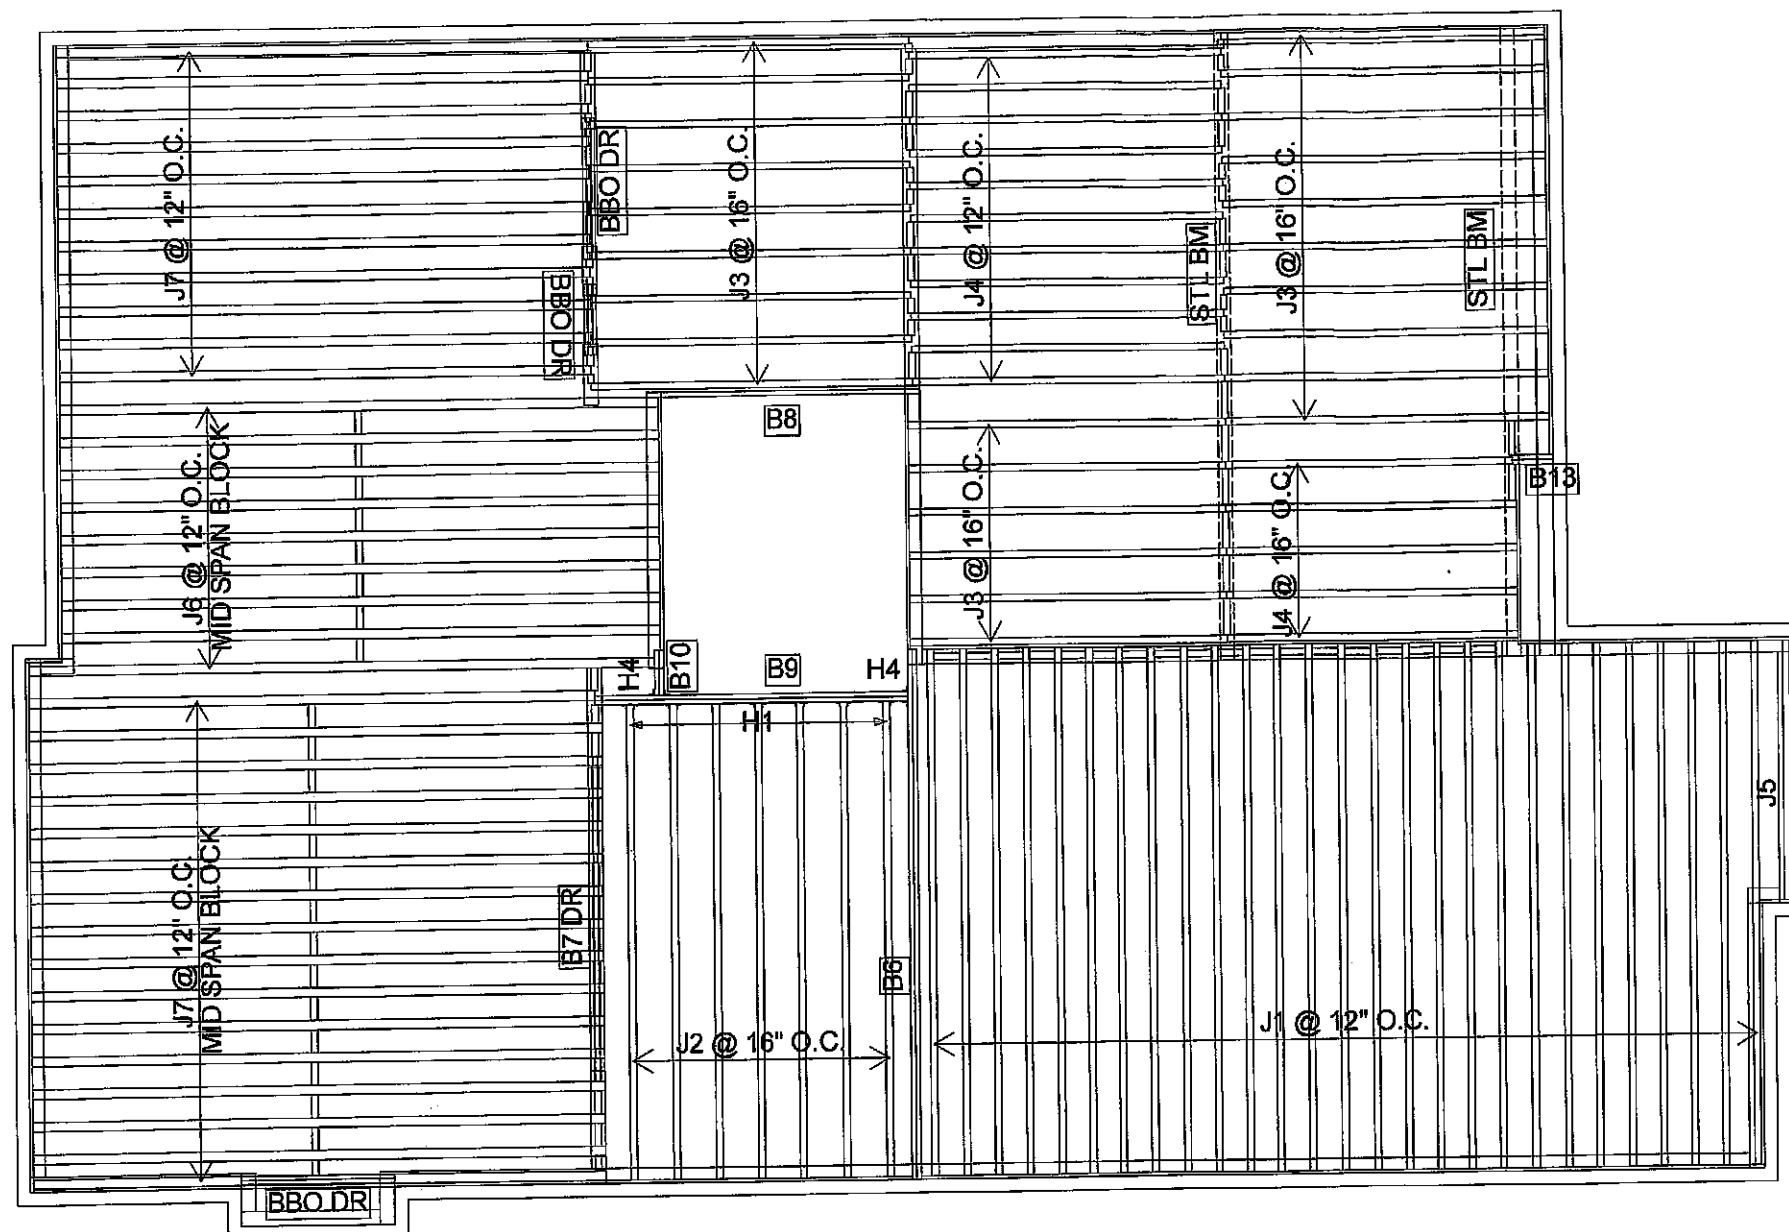

Products				
PlotID	Length	Product	Plies	Net Qty
J1	18-00-00	9 1/2" NI-40x	1	27
J2	16-00-00	9 1/2" NI-40x	1	7
J3	12-00-00	9 1/2" NI-40x	1	25
J4	10-00-00	9 1/2" NI-40x	1	16
J5	8-00-00	9 1/2" NI-40x	1	1
J6	20-00-00	9 1/2" NI-80	1	9
J7	18-00-00	9 1/2" NI-80	1	27
B6	18-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B8	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B9	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B7 DR	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3
B10	2-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B13	2-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2

Connector Summary		
Qty	Manuf	Product
7	H1	IUS2.56/9.5
2	H4	HGUS410

CITY OF HAMILTON  
Building Division

Permit No. 20-199448

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

CHIEF BUILDING OFFICIAL DATE 01/15/21

# NORDIC STRUCTURES

COMPANY  
Apr. 9, 2020 09:52


PROJECT  
J1 1ST FLOOR.wwb

## Design Check Calculation Sheet Nordic Sizer – Canada 7.2

### Loads:

Load	Type	Distribution	Pat- tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

### Maximum Reactions (lbs) and Support Bearing (in):

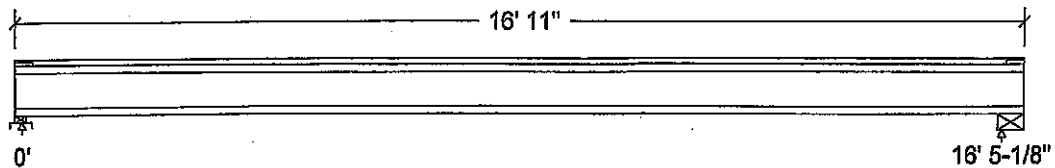

Unfactored:			
Dead	164		164
Live	329		329
Factored:			
Total	698		698
Bearing:			
Capacity			
Joist	1865		1893
Support	3971		-
Des ratio			
Joist	0.37		0.37
Support	0.18		-
Load case	#2		#2
Length	2-3/8		5-1/4
Min req'd	1-3/4		1-3/4
Stiffener	No		No
KD	1.00		1.00
KB support	1.00		-
fcp sup	769		-
Kzcp sup	1.09		-

### Nordic 9-1/2" NI-40x Floor joist @ 12" o.c.

Supports: 1 - Lumber Sill plate, No.1/No.2; 2 - Steel Beam, W;  
Total length: 16' 11"; Clear span: 16' 3-3/8"; 3/4" nailed and glued OSB sheathing  
This section PASSES the design code check.

### Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 698	Vr = 1895	lbs	Vf/Vr = 0.37
Moment (+)	Mf = 2867	Mr = 4824	lbs-ft	Mf/Mr = 0.59
Perm. Defl'n	0.14 = < L/999	0.55 = L/360	in	0.25
Live Defl'n	0.27 = L/721	0.41 = L/480	in	0.67
Total Defl'n	0.41 = L/480	0.82 = L/240	in	0.50
Bare Defl'n	0.33 = L/603	0.55 = L/360	in	0.60
Vibration	Lmax = 16'-5.1	Lv = 17'-1.8	ft	0.96
Defl'n	= 0.034	= 0.039	in	0.87



DWG NO. YAM6062-20  
STRUCTURAL  
COMPONENT ONLY

**Additional Data:**

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
EI	218.1 million	-	-	-	-	-	-	-	#2

**CRITICAL LOAD COMBINATIONS:**

Shear : LC #2 = 1.25D + 1.5L  
 Moment(+) : LC #2 = 1.25D + 1.5L  
 Deflection: LC #1 = 1.0D (permanent)  
               LC #2 = 1.0D + 1.0L (live)  
               LC #2 = 1.0D + 1.0L (total)  
               LC #2 = 1.0D + 1.0L (bare joist)  
 Bearing : Support 1 - LC #2 = 1.25D + 1.5L  
               Support 2 - LC #2 = 1.25D + 1.5L  
 Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake  
               L=live(use,occupancy) Ls=live(storage,equipment) f=fire  
 Load Patterns: s=S/2 L=L+Ls \_=no pattern load in this span  
 All Load Combinations (LCs) are listed in the Analysis output

**CALCULATIONS:**


E<sub>ieff</sub> = 265.29 lb-in<sup>2</sup> K= 4.94e06 lbs  
 "Live" deflection is due to all non-dead loads (live, wind, snow...)

CONFORMS TO OBC 2012

AMENDED 2020

**Design Notes:**

1. WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4, and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to Nordic Structures technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.

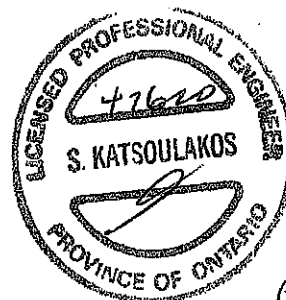

DWG NO. YAM 6062-20  
 STRUCTURAL  
 COMPONENT ONLY

# NORDIC STRUCTURES

COMPANY  
Apr. 9, 2020 09:52


PROJECT  
J1 2ND FLOOR.wwb

## Design Check Calculation Sheet Nordic Sizer - Canada 7.2

### Loads:

Load	Type	Distribution	Pat-tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

### Maximum Reactions (lbs) and Support Bearing (in):

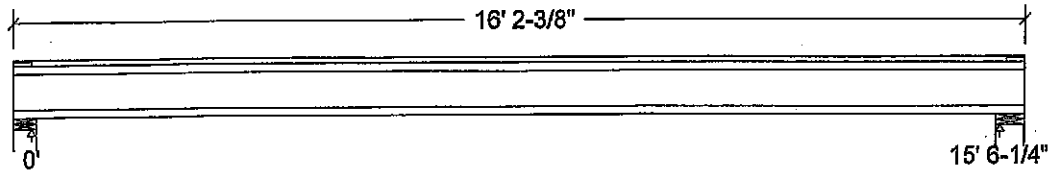

Unfactored:			
Dead	155		155
Live	310		310
Factored:			
Total	660		660
Bearing:			
Capacity			
Joist	1893		1893
Support	7744		9724
Des ratio			
Joist	0.35		0.35
Support	0.09		0.07
Load case	#2		#2
Length	4-3/8		5-1/2
Min req'd	1-3/4		1-3/4
Stiffener	No		No
KD	1.00		1.00
KB support	-		-
fcp sup	769		769
Kzcp sup	-		-

Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

### Nordic 9-1/2" NI-40x Floor joist @ 12" o.c.


Supports: All - Lumber Wall, No.1/No.2

Total length: 16' 2-3/8"; Clear span: 15' 4-1/2"; 5/8" nailed and glued OSB sheathing with 1/2" gypsum ceiling

This section PASSES the design code check.

### Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 660	Vr = 1895	lbs	Vf/Vr = 0.35
Moment(+)	Mf = 2559	Mr = 4824	lbs-ft	Mf/Mr = 0.53
Perm. Defl'n	0.11 = < L/999	0.52 = L/360	in	0.22
Live Defl'n	0.23 = L/825	0.39 = L/480	in	0.58
Total Defl'n	0.34 = L/550	0.78 = L/240	in	0.44
Bare Defl'n	0.26 = L/708	0.52 = L/360	in	0.51
Vibration	Lmax = 15'-6.3	Lv = 16'-8.5	ft	0.93
Defl'n	= 0.033	= 0.042	in	0.79

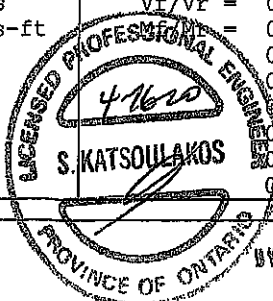

OWN NO. TAW 6063 -20  
STRUCTURAL

**Additional Data:**

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
EI	218.1 million	-	-	-	-	-	-	-	#2

**CRITICAL LOAD COMBINATIONS:**

Shear : LC #2 = 1.25D + 1.5L

Moment(+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake  
L=live(use,occupancy) Ls=live(storage,equipment) f=fire

Load Patterns: s=S/2 L=L+Ls \_=no pattern load in this span

All Load Combinations (LCs) are listed in the Analysis output

**CALCULATIONS:**E<sub>ieff</sub> = 258.29 lb-in<sup>2</sup> K= 4.94e06 lbs

"Live" deflection is due to all non-dead loads (live, wind, snow...)

CONFORMS TO OBC 2012

AMENDED 2020

**Design Notes:**

1. WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4, and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to Nordic Structures technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



SWH NO. YAM 6063 -20  
STRUCTURAL  
COMPONENT ONLY

# NORDIC STRUCTURES

COMPANY  
Apr. 9, 2020 09:51


PROJECT  
J6 2ND FLOOR.wwb

## Design Check Calculation Sheet Nordic Sizer - Canada 7.2

### Loads:

Load	Type	Distribution	Pat- tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

### Maximum Reactions (lbs) and Support Bearing (in):

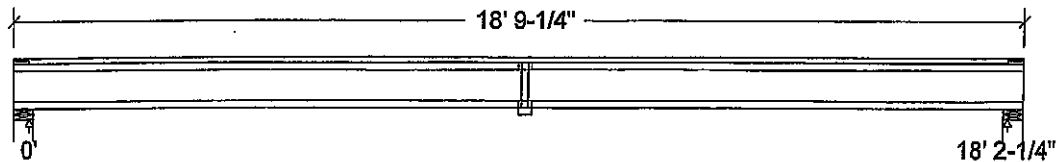

Unfactored:			
Dead	182		182
Live	364		364
Factored:			
Total	773		773
Bearing:			
Capacity			
Joist	1893		1893
Support	10841		10841
Des ratio			
Joist	0.41		0.41
Support	0.07		0.07
Load case	#2		#2
Length	4-3/8		4-3/8
Min req'd	1-3/4		1-3/4
Stiffener	No		No
KD	1.00		1.00
KB support	-		-
fcp sup	769		769
Kzcp sup	-		-

Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

### Nordic 9-1/2" NI-80 Floor joist @ 12" o.c.


Supports: All - Lumber Wall, No.1/No.2

Total length: 18' 9-1/4"; Clear span: 18' 1/2"; 5/8" nailed and glued OSB sheathing with 1 row of blocking; strapping at blocking locations and 1/2" gypsum ceiling

This section PASSES the design code check.

### Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 773	Vr = 1895	lbs	Vf/Vr = 0.41
Moment (+)	Mf = 3514	Mr = 8958	lbs-ft	0.39
Perm. Defl'n	0.15 = < L/999	0.61 = L/360	in	0.25
Live Defl'n	0.30 = L/726	0.45 = L/480	in	0.66
Total Defl'n	0.45 = L/484	0.91 = L/240	in	0.50
Bare Defl'n	0.34 = L/649	0.61 = L/360	in	0.55
Vibration	Lmax = 18'-2.3	Lv = 20'-0.5	ft	0.91
Defl'n	= 0.028	= 0.034	in	0.81



DWG NO. TAM 6064-20  
STRUCTURAL

**Additional Data:**

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	8958	1.00	1.00	-	1.000	-	-	-	#2
EI	324.1 million	-	-	-	-	-	-	-	#2

**CRITICAL LOAD COMBINATIONS:**

Shear : LC #2 = 1.25D + 1.5L

Moment(+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake  
L=live(use,occupancy) Ls=live(storage,equipment) f=fire

Load Patterns: s=S/2 L=L+Ls \_=no pattern load in this span

All Load Combinations (LCs) are listed in the Analysis output

**CALCULATIONS:**E<sub>I</sub>eff = 367.27 lb-in<sup>2</sup> K= 4.94e06 lbs


"Live" deflection is due to all non-dead loads (live, wind, snow...)

CONFORMS TO OBC 2012

AMENDED 2020

**Design Notes:**

1. WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4, and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to Nordic Structures technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.

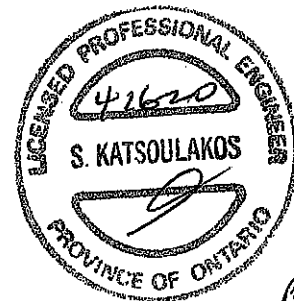

DWG NO. TAW 6064-20  
STRUCTURAL  
COMPONENT ONLY



**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****1ST FLR FRAMING\Flush Beams\B1(1498) (Flush Beam)**

BC CALC® Member Report

Dry | 1 span | No cant.

February 7, 2020 09:30:29

Build 7239

Job name:

File name: MOUNTAINASH 5 EL 1.mmdl

Address:

Description: 1ST FLR FRAMING\Flush Beams\B1(1498)

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

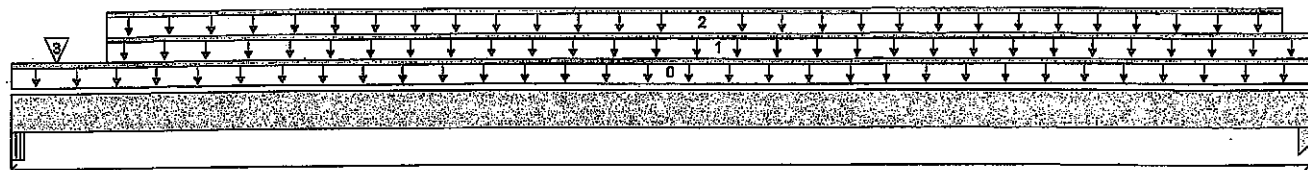

05-11-12

B1

B2

Total Horizontal Product Length = 05-11-12

**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 5-1/4"	147 / 0	289 / 0		
B2, 1-3/4"	77 / 0	228 / 0		

**Load Summary**

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.85	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	05-11-12	Top		10			00-00-00
1	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-05-04	05-11-12	Top	27	14			n/a
2	WALL	Unf. Lin. (lb/ft)	L	00-05-04	05-10-00	Top		60			n/a
3	12(1619)	Conc. Pt. (lbs)	L	00-02-08	00-02-08	Top	72	60			n/a

**Controls Summary**

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	443 ft-lbs	15093 ft-lbs	2.9%	0	03-01-10
End Shear	222 lbs	7521 lbs	3.0%	0	01-02-12
Total Load Deflection	L/999 (0.005")	n/a	n/a	4	03-01-10
Live Load Deflection	L/999 (0.001")	n/a	n/a	5	03-01-10
Max Defl.	0.005"	n/a	n/a	4	03-01-10
Span / Depth	7.0				

**Bearing Supports**

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 5-1/4" x 3-1/2"	405 lbs	7.9%	2.8%	Unspecified
B2	Column 1-3/4" x 3-1/2"	319 lbs	12.3%	6.6%	Unspecified

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.


Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86. **AMENDED 2020**


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

**CONFORMS TO OBC 2012**

PROVIDE 3 ROWS OF 3/4" ARDOX  
SPIRAL NAILS @ 8" O/C FOR  
MULTI-PLY NAILING. MAINTAIN  
A MIN. 2" LUMBER EDGE/END  
DISTANCE. DO NOT USE AIR NAILS

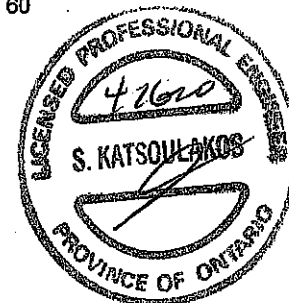

OWN NO. YAM 6065-20

**STRUCTURAL****COMPONENT ONLY****Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCIO®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports: CCMC 12472-R

Dry | 1 span | No cant.

February 7, 2020 09:30:29


File name: MOUNTAINASH 5 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B2(i1522)

Specifier:

Designer:

Company:

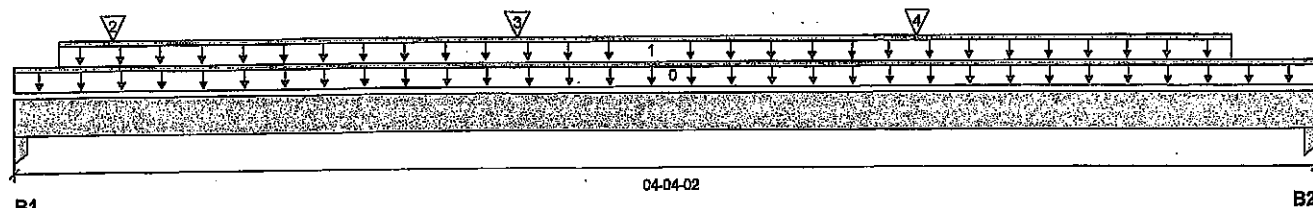

Total Horizontal Product Length = 04-04-02

### Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 1-3/4"	239 / 0	246 / 0		
B2, 3-1/2"	182 / 0	219 / 0		

### Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	04-04-02	Top		5			00-00-00
1	WALL	Unf. Lin. (lb/ft)	L	00-01-12	04-00-10	Top		60			n/a
2	J4(i1461)	Conc. Pt. (lbs)	L	00-03-14	00-03-14	Top	105	52			n/a
3	J4(i1445)	Conc. Pt. (lbs)	L	01-07-14	01-07-14	Top	158	79			n/a
4	J4(i1521)	Conc. Pt. (lbs)	L	02-11-14	02-11-14	Top	158	79			n/a

### Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	658 ft-lbs	11610 ft-lbs	5.7%	1	01-07-14
End Shear	480 lbs	5785 lbs	8.3%	1	03-03-02
Total Load Deflection	L/999 (0.006")	n/a	n/a	4	02-01-06
Live Load Deflection	L/999 (0.003")	n/a	n/a	5	02-01-06
Max Defl.	0.006"	n/a	n/a	4	02-01-06
Span / Depth	5.1				



DWG NO. FAM 6066-20

STRUCTURAL  
COMPONENT ONLY

### Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of Input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Column 1-3/4" x 1-3/4"	667 lbs	33.5%	17.9%	Unspecified
B2	Column 3-1/2" x 1-3/4"	546 lbs	13.7%	7.3%	Unspecified

### Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



# Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

**PASSED**

1ST FLR FRAMING\Flush Beams\B3(11455) (Flush Beam)

Dry | 1 span | No cant.

February 7, 2020 09:30:29

BC CALC® Member Report

Build 7239

Job name:

File name: MOUNTAINASH 5 EL 1.mmdl

Address:

Description: 1ST FLR FRAMING\Flush Beams\B3(11455)

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

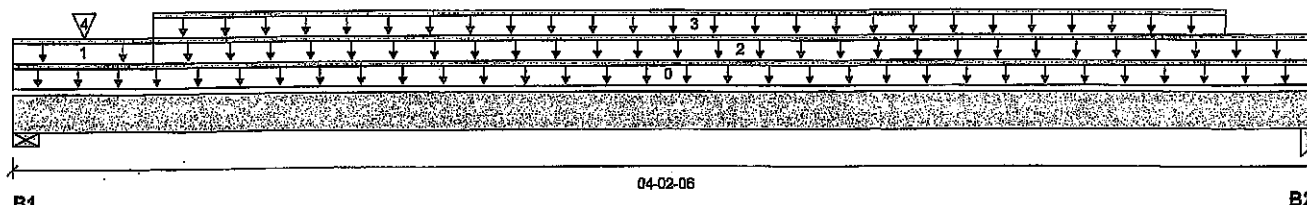

Total Horizontal Product Length = 04-02-06

## Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/2"	32 / 0	188 / 0		
B2, 3-1/2"	19 / 0	123 / 0		

## Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	04-02-06	Top	1.00	0.65	1.00	1.15	00-00-00
1	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	00-05-08	Top	8				n/a
2	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-05-08	04-02-06	Top	9	5			n/a
3	WALL	Unf. Lin. (lb/ft)	L	00-05-08	03-10-14	Top		60			n/a
4	10(1544)	Conc. Pt. (lbs)	L	00-02-12	00-02-12	Top	12	64			n/a

## Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	155 ft-lbs	7546 ft-lbs	2.1%	0	02-02-03
End Shear	91 lbs	3761 lbs	2.4%	0	01-03-00
Total Load Deflection	L/999 (0.001")	n/a	n/a	4	02-02-03
Live Load Deflection	L/999 (0")	n/a	n/a	5	02-02-03
Max Defl.	0.001"	n/a	n/a	4	02-02-03
Span / Depth	4.5				

## Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 5-1/2" x 1-3/4"	263 lbs	6.8%	3.4%	Spruce-Pine-Fir
B2	Column 3-1/2" x 1-3/4"	172 lbs	6.6%	3.5%	Unspecified

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020

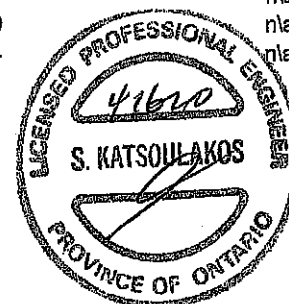

DWG NO. TAM 6067-20  
STRUCTURAL  
COMPONENT ONLY

## Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports: CCMC 12472-R


File name: MOUNTAINASH 5 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B4(i1440)

Specifier:

Designer:

Company:

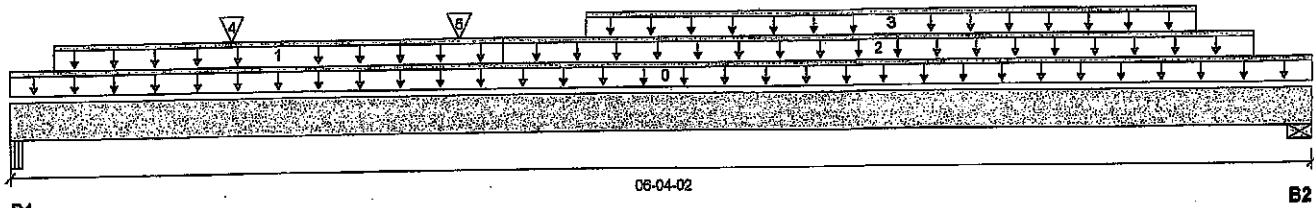

Total Horizontal Product Length = 06-04-02

### Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/4"	1442 / 0	799 / 0		
B2, 3-1/2"	1552 / 0	826 / 0		

### Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	06-04-02	Top	10				00-00-00
1	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-02-10	02-04-10	Top	26	13			n/a
2	STAIR	Unf. Lin. (lb/ft)	L	02-04-10	06-00-10	Top	240	120			n/a
3	Smoothed Load	Unf. Lin. (lb/ft)	L	02-09-08	05-09-08	Top	341	170			n/a
4	J1(i1486)	Conc. Pt. (lbs)	L	01-00-14	01-00-14	Top	316	158			n/a
5		Conc. Pt. (lbs)	L	02-02-01	02-02-01	Top	695	418			n/a

### Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	5363 ft-lbs	23220 ft-lbs	23.1%	1	03-03-06
End Shear	2948 lbs	11571 lbs	25.5%	1	01-02-12
Total Load Deflection	L/999 (0.044")	n/a	n/a	4	03-03-06
Live Load Deflection	L/999 (0.029")	n/a	n/a	5	03-03-06
Max Defl.	0.044"	n/a	n/a	4	03-03-06
Span / Depth	7.2				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Beam	5-1/4" x 3-1/2"	3161 lbs	40.3%	14.1%	Unspecified
B2 Wall/Plate	3-1/2" x 3-1/2"	3360 lbs	44.6%	22.5%	Spruce-Pine-Fir

### Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 8" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS



ENG NO. 41620  
STRUCTURAL  
COMPONENT ONLY

### Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



# Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

**PASSED**

## 1ST FLR FRAMING\Flush Beams\B5(11548) (Flush Beam)

Dry | 1 span | No cant.

February 7, 2020 09:30:29

BC CALC® Member Report

Build 7239

Job name:

File name: MOUNTAINASH 5 EL 1.mmdl

Address:

Description: 1ST FLR FRAMING\Flush Beams\B5(11548)

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

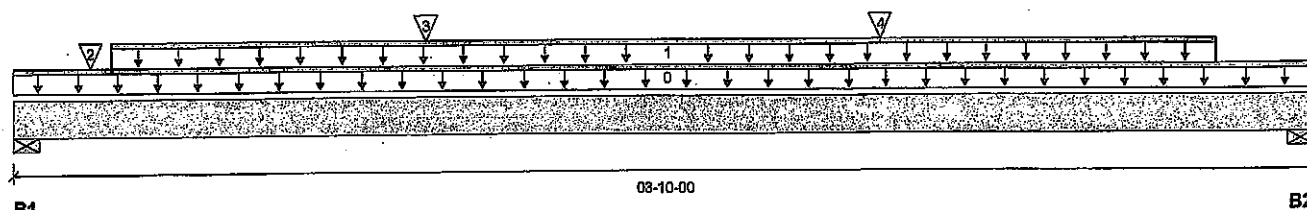

Total Horizontal Product Length = 03-10-00

### Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	1050 / 0	535 / 0		
B2, 3-1/2"	766 / 0	392 / 0		

### Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	03-10-00	Top	1.00	0.65	1.00	1.15	00-00-00
1	STAIR	Unf. Lin. (lb/ft)	L	00-03-08	03-06-08	Top	240	120			n/a
2	J2(11488)	Conc. Pt. (lbs)	L	00-02-12	00-02-12	Top	289	145			n/a
3	J2(11439)	Conc. Pt. (lbs)	L	01-02-08	01-02-08	Top	341	171			n/a
4	J2(11540)	Conc. Pt. (lbs)	L	02-06-08	02-06-08	Top	403	201			n/a

### Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1549 ft-lbs	11610 ft-lbs	13.3%	1	02-00-08
End Shear	1228 lbs	5785 lbs	21.2%	1	02-09-00
Total Load Deflection	L/999 (0.009")	n/a	n/a	4	01-11-00
Live Load Deflection	L/999 (0.006")	n/a	n/a	5	01-11-00
Max Defl.	0.009"	n/a	n/a	4	01-11-00
Span / Depth	4.3				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 3-1/2" x 1-3/4"	2244 lbs	59.6%	30.0%	Spruce-Pine-Fir
B2	Wall/Plate 3-1/2" x 1-3/4"	1639 lbs	43.5%	21.9%	Spruce-Pine-Fir

### Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



OWN NO. YAW 6069-20  
STRUCTURAL  
COMPONENT ONLY

### Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



**Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP**  
**2ND FLR FRAMING\Dropped Beams\B7 DR(1989) (Dropped Beam)**  
 Dry | 1 span | No cant.

**PASSED**

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R

File name: MOUNTAINASH 5 EL 1.mmdl


Description: 2ND FLR FRAMING\Dropped Beams\B7 DR(1989)

Specifier:

Designer:

Company:

February 7, 2020 09:30:29

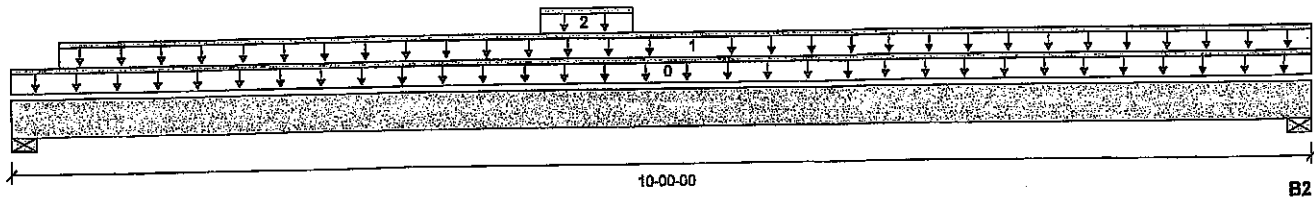

Total Horizontal Product Length = 10-00-00

**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 4"	1592 / 0	868 / 0		
B2, 4"	1824 / 0	984 / 0		

**Load Summary**

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	10-00-00	Top	1.00	0.65	1.00	1.15	00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-04-08	10-00-00	Top	341	170			n/a
2	Bk2(11151)	Unf. Lin. (lb/ft)	L	04-00-04	04-08-12	Top	136	68			n/a

**Controls Summary**

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	8666 ft-lbs	36222 ft-lbs	23.9%	1	04-10-08
End Shear	3250 lbs	17356 lbs	18.7%	1	08-10-08
Total Load Deflection	L/875 (0.13")	n/a	27.4%	4	05-00-00
Live Load Deflection	L/999 (0.084")	n/a	n/a	5	05-00-00
Max Defl.	0.13"	n/a	n/a	4	05-00-00
Span / Depth	11.9				

**Bearing Supports**


	Dlm. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 4" x 5-1/4"	3474 lbs	12.4%	13.6%	Spruce-Pine-Fir
B2	Wall/Plate 4" x 5-1/4"	3967 lbs	14.2%	15.5%	Spruce-Pine-Fir

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.  
 Design meets Code minimum (L/360) Live load deflection criteria.  
 Calculations assume unbraced length of Top: 00-02-04, Bottom: 00-02-04.  
 Resistance Factor phi has been applied to all presented results per CSA O86.  
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.  
 Design based on Dry Service Condition.  
 Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



PROVIDE 3 ROWS OF 3/4" ARBOX SPIRAL NAILS @ 12" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS. STAGGER NAILS 6" BETWEEN PLYS.



ENG NO. TAM 6070-20  
**STRUCTURAL COMPONENT ONLY**

**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B10(11567) (Flush Beam)**

BC CALC® Member Report

Dry | 1 span | No cant.

February 7, 2020 09:30:29

Build 7239

Job name:

File name: MOUNTAINASH 5 EL 1.mmd

Address:

Description: 2ND FLR FRAMING\Flush Beams\B10(11567)

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

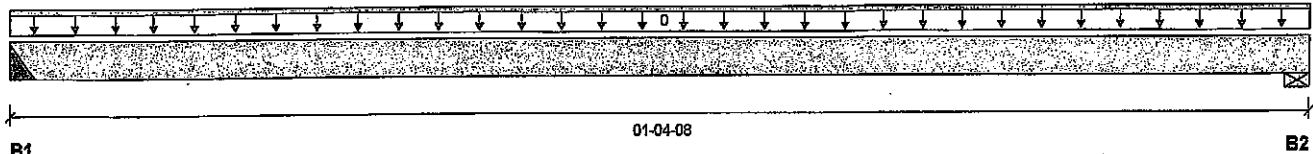

Total Horizontal Product Length = 01-04-08

**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 4"		6 / 0		
B2, 6-1/2"		8 / 0		

**Load Summary**

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	01-04-08	Top	1.00	0.65	1.00	1.15	00-00-00

**Controls Summary**

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1 ft-lbs	15093 ft-lbs	n/a	0	00-07-00
End Shear	3 lbs	7521 lbs	n/a	0	00-04-00
Span / Depth	0.8				

**Bearing Supports**

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Hanger 4" x 3-1/2"	8 lbs	n/a	n/a	HGUS410
B2	Wall/Plate 6-1/2" x 3-1/2"	11 lbs	0.1%	n/a	Spruce-Pine-Fir

**Cautions**

Header for the hanger HGUS410 at B1 is a Double 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF. Hanger model HGUS410 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

**Notes**

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO QRC 2012

AMENDED 2020



PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 6" O/C FOR MULTI-PLY NAILING, MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS



HWG NO. TAM 6071 -20  
STRUCTURAL  
COMPONENT ONLY

**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJST™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®.

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 5 EL 1.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B13(i625)

Specifier:

Designer:

Company:

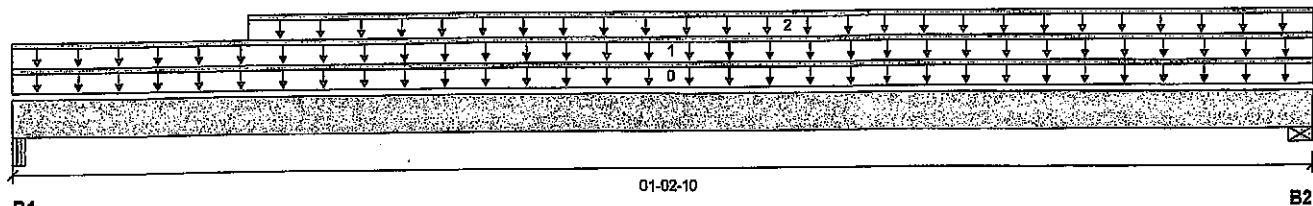

Total Horizontal Product Length = 01-02-10

**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 2-5/8"	42 / 0	41 / 0	72 / 0	
B2, 5-1/2"	66 / 0	63 / 0	107 / 0	

**Load Summary**

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	01-02-10	Top		10			00-00-00
1	ROOF	Unf. Lin. (lb/ft)	L	00-00-00	01-02-10	Top	77	70	147		n/a
2	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-02-10	01-02-10	Top	14	7			n/a

**Controls Summary**

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	23 ft-lbs	23220 ft-lbs	0.1%	13	00-05-14
End Shear	114 lbs	11571 lbs	1.0%	13	00-02-10
Span / Depth	0.8				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Beam	2-5/8" x 3-1/2"	201 lbs	5.1%	1.8%	Unspecified
B2 Wall/Plate	5-1/2" x 3-1/2"	306 lbs	2.6%	1.3%	Spruce-Pine-Fir

**Notes**

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.


Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 4" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS



UWB NO. TAM 6072-20

STRUCTURAL

COMPONENT ONLY

**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA).

Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,





Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B6(i1574) (Flush Beam)**

BC CALC® Member Report

Dry | 1 span | No cant.

February 7, 2020 09:30:29

Build 7239

Job name:

File name: MOUNTAINASH 5 EL 1.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B6(i1574)

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

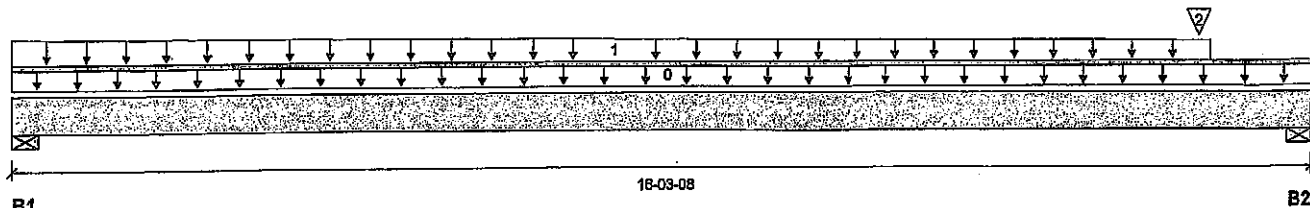**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 5-1/2"	332 / 0	247 / 0		
B2, 5-1/2"	1753 / 0	999 / 0		

**Load Summary**

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	16-03-08	Top	1.00	0.65	1.00	1.15	00-00-00
1	FC2 Floor Material	Trapezoidal (lb/ft)	L	00-00-00	15-00-00	Top	29	15			n/a
2	B9(i1577)	Conc. Pt. (lbs)	L	14-10-04	14-10-04	Top	23	11			n/a
							1686	890			

**Controls Summary**

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	4312 ft-lbs	23220 ft-lbs	18.6%	1	11-08-00
End Shear	3844 lbs	11571 lbs	33.2%	1	15-00-08
Total Load Deflection	L/703 (0.265")	n/a	34.1%	4	08-08-04
Live Load Deflection	L/1176 (0.158")	n/a	30.6%	5	08-08-04
Max Defl.	0.265"	n/a	n/a	4	08-08-04
Span / Depth	19.6				

**Bearing Supports**

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 5-1/2" x 3-1/2"	807 lbs	6.8%	3.4%	Spruce-Pine-Fir
B2	Wall/Plate 5-1/2" x 3-1/2"	3877 lbs	32.7%	16.5%	Spruce-Pine-Fir

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.


Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 12" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS

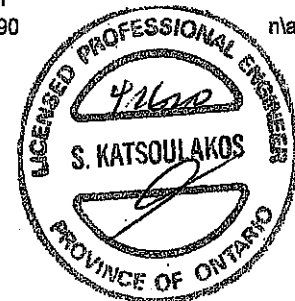

OBC NO. TAN 6073-20  
STRUCTURAL  
COMPONENT ONLY

**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports: CCMC 12472-R


File name: MOUNTAINASH 5 EL 1.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B8(I1569)

Specifier:

Designer:

Company:

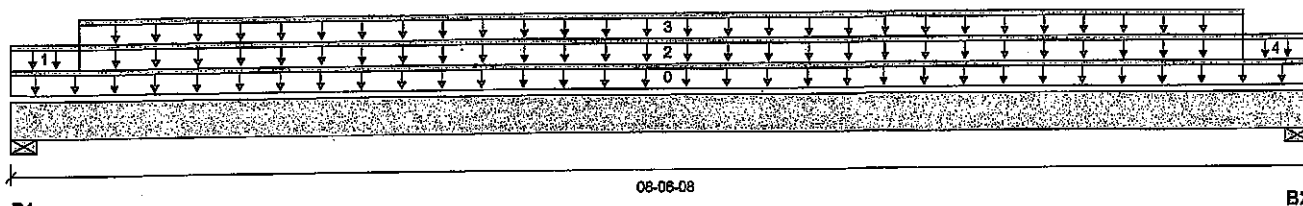

Total Horizontal Product Length = 08-06-08

**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 5-1/2"	32 / 0	265 / 0		
B2, 5-1/2"	30 / 0	264 / 0		

**Load Summary**

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	08-06-08	Top		5			00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	00-05-08	Top	10				n/a
2	WALL	Unf. Lin. (lb/ft)	L	00-05-08	08-01-00	Top		60			n/a
3	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-05-08	08-01-00	Top	7	4			n/a
4	FC2 Floor Material	Unf. Lin. (lb/ft)	L	08-01-00	08-06-08	Top	6				n/a

**Controls Summary**

	Factored Demand	Factored Resistance	Demand/ Resistance	Case	Location
Pos. Moment	718 ft-lbs	7546 ft-lbs	9.5%	0	04-03-04
End Shear	289 lbs	3761 lbs	7.7%	0	01-03-00
Total Load Deflection	L/999 (0.024")	n/a	n/a	4	04-03-04
Live Load Deflection	L/999 (0.002")	n/a	n/a	5	04-03-04
Max Defl.	0.024"	n/a	n/a	4	04-03-04
Span / Depth	9.8				

Bearing Supports	Dlm. (LxW)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material
B1	Wall/Plate 5-1/2" x 1-3/4"	371 lbs	9.6%	4.9%	Spruce-Pine-Fir
B2	Wall/Plate 5-1/2" x 1-3/4"	370 lbs	9.6%	4.8%	Spruce-Pine-Fir

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020

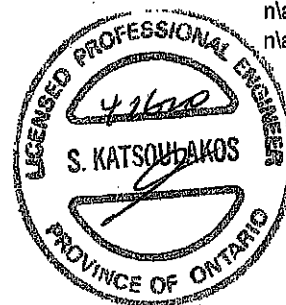

DWG NO. TAM 6074-20

STRUCTURAL

COMPONENT ONLY

**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 5 EL 1.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B9(i1577)

Specifier:

Designer:

Company:

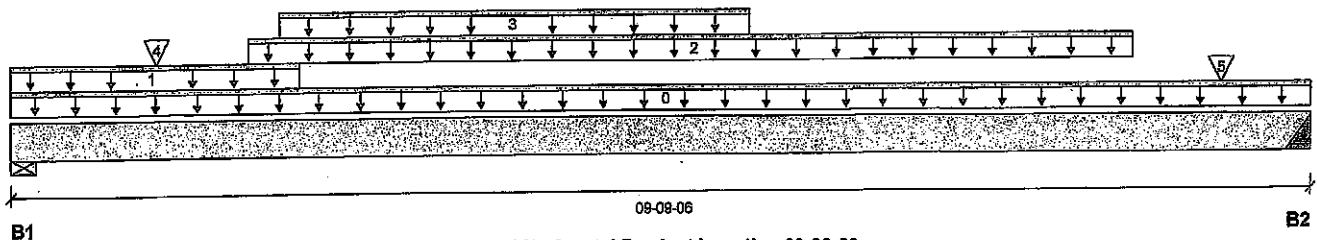
**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 2-3/4"	1918 / 0	1008 / 0		
B2, 4"	1730 / 0	914 / 0		

**Load Summary**

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	09-09-06	Top		10			00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	02-01-14	Top	23	11			n/a
2	Smoothed Load	Unf. Lin. (lb/ft)	L	01-09-04	08-05-04	Top	298	149			n/a
3	STAIR	Unf. Lin. (lb/ft)	L	02-00-01	05-06-01	Top	240	120			n/a
4	J2(i675)	Conc. Pt. (lbs)	L	01-01-04	01-01-04	Top	451	225			n/a
5	J2(i673)	Conc. Pt. (lbs)	L	09-01-04	09-01-04	Top	321	161			n/a

**Controls Summary**

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	10260 ft-lbs	23220 ft-lbs	44.1%	1	04-07-04
End Shear	4076 lbs	11571 lbs	35.2%	1	01-00-04
Total Load Deflection	L/501 (0.224")	n/a	47.9%	4	04-09-04
Live Load Deflection	L/763 (0.147")	n/a	47.2%	5	04-09-04
Max Defl.	0.224"	n/a	n/a	4	04-09-04
Span / Depth	11.8				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 2-3/4" x 3-1/2"	4138 lbs	69.9%	35.2%	Spruce-Pine-Fir
B2	Hanger 4" x 3-1/2"	3738 lbs	n/a	21.9%	HGUS410

**Cautions**

Header for the hanger HGUS410 at B2 is a Double 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF.  
 Hanger model HGUS410 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.



P6 1/2  
 PWS NO. TAM 6075-20  
 STRUCTURAL  
 COMPONENT ONLY



# Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

## 2ND FLR FRAMING\Flush Beams\B9(11577) (Flush Beam)

Dry | 1 span | No cant.

February 7, 2020 09:30:29

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R

File name: MOUNTAINASH 5 EL 1.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B9(11577)

Specifier:

Designer:

Company:

### Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



PROVIDE 3 ROWS OF 3/4" ARDXX  
SPIRAL NAILS @ 8" O/C FOR  
MULTI-PLY NAILING. MAINTAIN  
A MIN. 2" LUMBER EDGE/END  
DISTANCE. DO NOT USE AIR NAILS



DWG NO. TAM 6075-20  
STRUCTURAL  
COMPONENT ONLY

### Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®.



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP  
2ND FLR FRAMING\Flush Beams\B15(i1694) (Flush Beam)

PASSED

BC CALC® Member Report

Dry | 2 spans | No cant.

February 7, 2020 10:01:17

Build 7239

Job name:

File name: MOUNTAINASH 5 EL 3.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B15(i1694)

City, Province, Postal Code: WATERDOWN

Specifier:


Customer:

Designer: AJ

Code reports:

CCMC 12472-R

Company:

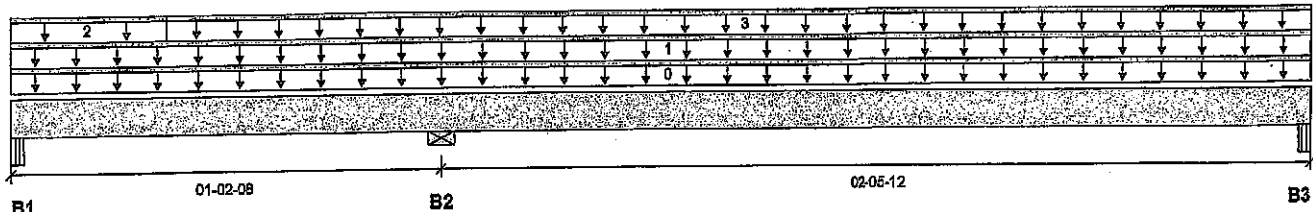

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/4"	77 / 47	27 / 0	77 / 14	
B2, 5-1/2"	215 / 0	197 / 0	320 / 0	
B3, 5-1/4"	122 / 1	111 / 0	181 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	03-08-04	Top		10			00-00-00
1	ROOF	Unf. Lin. (lb/ft)	L	00-00-00	03-08-04	Top	77	70	147		n/a
2	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	00-05-04	Top	27	13			n/a
3	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-05-04	03-08-04	Top	22	11			n/a


Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	159 ft-lbs	23220 ft-lbs	0.7%	66	02-05-08
Neg. Moment	-182 ft-lbs	-23220 ft-lbs	0.8%	49	01-02-08
End Shear	134 lbs	11571 lbs	1.2%	18	00-05-04
Cont. Shear	299 lbs	11571 lbs	2.6%	67	00-11-12
Total Load Deflection	L/999 (0")	n/a	n/a	126	02-04-05
Live Load Deflection	L/999 (0")	n/a	n/a	178	02-04-05
Max Defl.	0"	n/a	n/a	126	02-04-05
Span / Depth	2.7				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Beam	5-1/4" x 3-1/2"	227 lbs	2.3%	1.0%	Unspecified
B2 Wall/Plate	5-1/2" x 3-1/2"	940 lbs	7.9%	4.0%	Spruce-Pine-Fir
B3 Beam	5-1/4" x 3-1/2"	533 lbs	5.4%	2.4%	Unspecified

Cautions

Uplift of 60 lbs found at bearing B1. (SIMPSON 2-H2-5A @ B1)

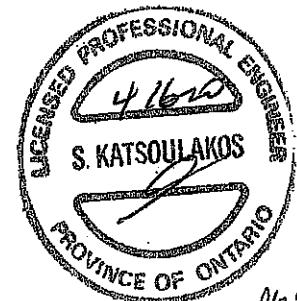

BWG NO. TAM 6076-20  
STRUCTURAL  
COMPONENT ONLY



**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP**  
**2ND FLR FRAMING\Flush Beams\B15(i1694) (Flush Beam)**

**PASSED**

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code: WATERDOWN

Customer:

Code reports: CCMC 12472-R

Dry | 2 spans | No cant.

February 7, 2020 10:01:17

File name: MOUNTAINASH 5 EL 3.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B15(i1694)

Specifier:

Designer: AJ

Company:

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.


Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

**CONFORMS TO OBC 2012**

**AMENDED 2020**



PROVIDE 3 ROWS OF 3/8" ARDOX  
SPIRAL NAILS @ 8" O/C FOR  
MULTI-PLY NAILING. MAINTAIN  
A MIN. 2" LUMBER EDGE/END  
DISTANCE. DO NOT USE AIR NAILS



ENG NO. YAM 6076-20  
**STRUCTURAL  
COMPONENT ONLY**

**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

Build 7239

Job name:

Address:

City, Province, Postal Code: WATERDOWN

Customer:

Code reports: CCMC 12472-R


File name: MOUNTAINASH 5 EL 1 DECK CONDITION.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B1A(i1996)

Specifier:

Designer: AJ

Company:

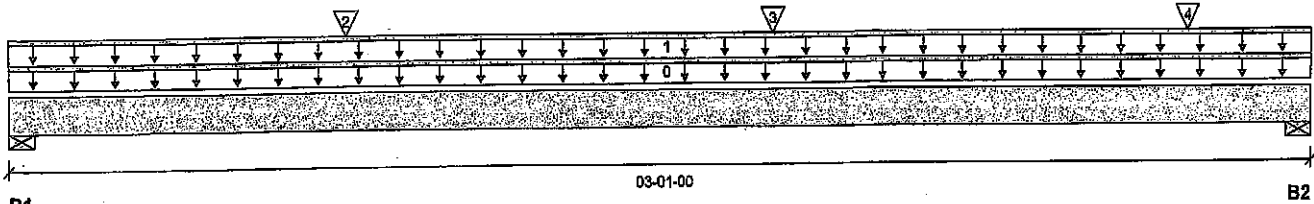

Total Horizontal Product Length = 03-01-00

### Reaction Summary (Down / Uplift) (lbs)


Bearing	Live	Dead	Snow	Wind
B1, 3"	923 / 0	601 / 0		
B2, 3"	1134 / 0	706 / 0		

### Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	03-01-00	Top	100	0.65	1.00	1.15	00-00-00
1	E1(i402)	Unf. Lin. (lb/ft)	L	00-00-00	03-01-00	Top	337	250			n/a
2	J1(i1927)	Conc. Pt. (lbs)	L	00-09-08	00-09-08	Top	339	169			n/a
3	J1(i1877)	Conc. Pt. (lbs)	L	01-09-08	01-09-08	Top	339	169			n/a
4	J1(i1942)	Conc. Pt. (lbs)	L	02-09-08	02-09-08	Top	339	169			n/a

### Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1386 ft-lbs	23220 ft-lbs	6.0%	1	01-08-06
End Shear	1690 lbs	11571 lbs	14.6%	1	01-00-08
Total Load Deflection	L/999 (0.003")	n/a	n/a	4	01-06-11
Live Load Deflection	L/999 (0.002")	n/a	n/a	5	01-06-11
Max Defl.	0.003"	n/a	n/a	4	01-06-11
Span / Depth	3.4				



Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 3" x 3-1/2"	2135 lbs	33.1%	16.7%	Spruce-Pine-Fir
B2	Wall/Plate 3" x 3-1/2"	2583 lbs	40.0%	20.2%	Spruce-Pine-Fir

### Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020

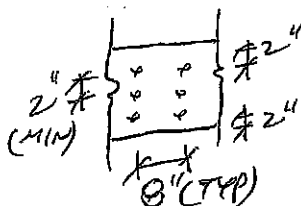

PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 8" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS

### DISCLOSURE

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

# Maximum Floor Spans

Live Load = 40 psf, Dead Load = 30 psf  
Simple Spans, L/480 Deflection Limit  
3/4" OSB G&N Sheathing




Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-2"	13'-4"	12'-4"	15'-7"	14'-2"	13'-4"	12'-4"
	NI-40x	17'-0"	16'-0"	15'-1"	13'-11"	17'-5"	16'-1"	15'-1"	13'-11"
	NI-60	17'-2"	16'-2"	15'-5"	14'-3"	17'-6"	16'-5"	15'-5"	14'-3"
	NI-70	18'-0"	16'-11"	16'-3"	15'-6"	18'-5"	17'-3"	16'-7"	15'-6"
	NI-80	18'-3"	17'-4"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	15'-10"
11-7/8"	NI-20	17'-10"	16'-10"	16'-0"	14'-10"	18'-6"	17'-1"	16'-0"	14'-10"
	NI-40x	19'-4"	17'-11"	17'-3"	15'-10"	19'-11"	18'-6"	17'-9"	15'-10"
	NI-60	19'-7"	18'-2"	17'-5"	16'-9"	20'-2"	18'-9"	17'-11"	17'-1"
	NI-70	20'-9"	19'-2"	18'-3"	17'-5"	21'-4"	19'-9"	18'-10"	17'-10"
	NI-80	21'-1"	19'-5"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
14"	NI-90x	21'-8"	20'-0"	19'-1"	18'-0"	22'-2"	20'-6"	19'-6"	18'-6"
	NI-40x	21'-5"	19'-10"	18'-11"	17'-5"	22'-1"	20'-6"	19'-6"	17'-5"
	NI-60	21'-10"	20'-2"	19'-3"	18'-2"	22'-5"	20'-10"	19'-11"	18'-10"
	NI-70	23'-0"	21'-3"	20'-3"	19'-2"	23'-8"	21'-11"	20'-10"	19'-9"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
16"	NI-90x	24'-1"	22'-3"	21'-2"	20'-0"	24'-8"	22'-10"	21'-9"	20'-7"
	NI-60	23'-9"	22'-0"	20'-11"	19'-10"	24'-6"	22'-9"	21'-8"	20'-6"
	NI-70	25'-1"	23'-2"	22'-0"	20'-10"	25'-9"	23'-10"	22'-9"	21'-6"
	NI-80	25'-6"	23'-6"	22'-4"	21'-2"	26'-1"	24'-2"	23'-1"	21'-10"
	NI-90x	26'-4"	24'-3"	23'-1"	21'-10"	26'-11"	24'-11"	23'-8"	22'-5"
Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-2"	13'-4"	12'-4"	15'-7"	14'-2"	13'-4"	12'-4"
	NI-40x	17'-9"	16'-1"	15'-1"	13'-11"	17'-9"	16'-1"	15'-1"	13'-11"
	NI-60	18'-1"	16'-5"	15'-5"	14'-3"	18'-1"	16'-5"	15'-5"	14'-3"
	NI-70	19'-10"	17'-11"	16'-9"	15'-6"	19'-10"	17'-11"	16'-9"	15'-6"
	NI-80	20'-2"	18'-3"	17'-1"	15'-10"	20'-2"	18'-3"	17'-1"	15'-10"
11-7/8"	NI-20	18'-10"	17'-1"	16'-0"	14'-10"	18'-10"	17'-1"	16'-0"	14'-10"
	NI-40x	21'-3"	19'-3"	17'-9"	15'-10"	21'-3"	19'-3"	17'-9"	15'-10"
	NI-60	21'-9"	19'-8"	18'-5"	17'-1"	21'-9"	19'-8"	18'-5"	17'-1"
	NI-70	23'-4"	21'-5"	20'-1"	18'-6"	23'-8"	21'-5"	20'-1"	18'-6"
	NI-80	23'-7"	21'-10"	20'-5"	18'-11"	24'-1"	21'-10"	20'-5"	18'-11"
14"	NI-90x	24'-3"	22'-6"	21'-3"	19'-7"	24'-8"	22'-7"	21'-3"	19'-7"
	NI-40x	24'-2"	21'-5"	19'-6"	17'-5"	24'-2"	21'-5"	19'-6"	17'-5"
	NI-60	24'-9"	22'-5"	21'-0"	19'-6"	24'-9"	22'-5"	21'-0"	19'-6"
	NI-70	26'-1"	24'-3"	22'-9"	21'-0"	26'-8"	24'-3"	22'-9"	21'-0"
	NI-80	26'-6"	24'-7"	23'-3"	21'-6"	27'-1"	24'-10"	23'-3"	21'-6"
16"	NI-90x	27'-3"	25'-4"	24'-1"	22'-4"	27'-9"	25'-10"	24'-3"	22'-4"
	NI-60	27'-3"	24'-11"	23'-5"	21'-7"	27'-6"	24'-11"	23'-5"	21'-7"
	NI-70	28'-8"	26'-8"	25'-3"	23'-4"	29'-3"	26'-11"	25'-3"	23'-4"
	NI-80	29'-1"	27'-0"	25'-9"	23'-10"	29'-8"	27'-6"	25'-10"	23'-10"
	NI-90x	29'-11"	27'-10"	26'-6"	24'-10"	30'-6"	28'-5"	26'-11"	24'-10"

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.



### Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf  
Simple Spans, L/480 Deflection Limit  
5/8" OSB G&N Sheathing



Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-2"	13'-5"	N/A	15'-7"	14'-8"	14'-2"	N/A
	NI-40x	16'-1"	15'-2"	14'-8"	N/A	16'-7"	15'-7"	15'-1"	N/A
	NI-60	16'-3"	15'-4"	14'-10"	N/A	16'-8"	15'-9"	15'-3"	N/A
	NI-70	17'-1"	16'-1"	15'-6"	N/A	17'-5"	16'-5"	15'-10"	N/A
	NI-80	17'-3"	16'-3"	15'-8"	N/A	17'-8"	16'-7"	16'-0"	N/A
11-7/8"	NI-20	16'-11"	16'-0"	15'-5"	N/A	17'-6"	16'-6"	16'-0"	N/A
	NI-40x	18'-1"	17'-0"	16'-5"	N/A	18'-9"	17'-6"	16'-11"	N/A
	NI-60	18'-4"	17'-3"	16'-7"	N/A	19'-0"	17'-8"	17'-1"	N/A
	NI-70	19'-6"	18'-0"	17'-4"	N/A	20'-1"	18'-7"	17'-9"	N/A
	NI-80	19'-9"	18'-3"	17'-6"	N/A	20'-4"	18'-10"	17'-11"	N/A
14"	NI-90x	20'-4"	18'-9"	17'-11"	N/A	20'-10"	19'-3"	18'-5"	N/A
	NI-40x	20'-1"	18'-7"	17'-10"	N/A	20'-10"	19'-4"	18'-6"	N/A
	NI-60	20'-5"	18'-11"	18'-1"	N/A	21'-2"	19'-7"	18'-9"	N/A
	NI-70	21'-7"	20'-0"	19'-1"	N/A	22'-3"	20'-7"	19'-8"	N/A
	NI-80	21'-11"	20'-3"	19'-4"	N/A	22'-7"	20'-11"	20'-0"	N/A
16"	NI-90x	22'-7"	20'-11"	19'-11"	N/A	23'-3"	21'-6"	20'-6"	N/A
	NI-60	22'-3"	20'-8"	19'-9"	N/A	23'-1"	21'-5"	20'-6"	N/A
	NI-70	23'-6"	21'-9"	20'-9"	N/A	24'-3"	22'-5"	21'-5"	N/A
	NI-80	23'-11"	22'-1"	21'-1"	N/A	24'-8"	22'-10"	21'-9"	N/A
	NI-90x	24'-8"	22'-9"	21'-9"	N/A	25'-4"	23'-5"	22'-4"	N/A

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-8"	15'-3"	14'-5"	N/A	16'-8"	15'-3"	14'-5"	N/A
	NI-40x	17'-11"	16'-11"	16'-1"	N/A	18'-5"	17'-1"	16'-1"	N/A
	NI-60	18'-2"	17'-1"	16'-4"	N/A	18'-7"	17'-4"	16'-4"	N/A
	NI-70	19'-2"	17'-10"	17'-2"	N/A	19'-7"	18'-3"	17'-7"	N/A
	NI-80	19'-5"	18'-0"	17'-4"	N/A	19'-10"	18'-5"	17'-8"	N/A
11-7/8"	NI-20	19'-6"	18'-1"	17'-3"	N/A	19'-11"	18'-3"	17'-3"	N/A
	NI-40x	21'-0"	19'-6"	18'-8"	N/A	21'-7"	20'-2"	19'-2"	N/A
	NI-60	21'-4"	19'-9"	18'-11"	N/A	21'-11"	20'-4"	19'-6"	N/A
	NI-70	22'-6"	20'-10"	19'-11"	N/A	23'-0"	21'-5"	20'-5"	N/A
	NI-80	22'-9"	21'-1"	20'-1"	N/A	23'-3"	21'-7"	20'-8"	N/A
14"	NI-90x	23'-4"	21'-8"	20'-8"	N/A	23'-10"	22'-2"	21'-2"	N/A
	NI-40x	23'-7"	21'-11"	20'-11"	N/A	24'-3"	22'-7"	21'-7"	N/A
	NI-60	24'-0"	22'-3"	21'-3"	N/A	24'-8"	22'-11"	21'-11"	N/A
	NI-70	25'-3"	23'-4"	22'-3"	N/A	25'-10"	24'-0"	22'-11"	N/A
	NI-80	25'-7"	23'-8"	22'-7"	N/A	26'-2"	24'-4"	23'-2"	N/A
16"	NI-90x	26'-4"	24'-4"	23'-3"	N/A	26'-10"	24'-11"	23'-9"	N/A
	NI-60	26'-5"	24'-6"	23'-4"	N/A	27'-2"	25'-3"	24'-2"	N/A
	NI-70	27'-9"	25'-8"	24'-6"	N/A	28'-5"	26'-5"	25'-2"	N/A
	NI-80	28'-2"	26'-1"	24'-10"	N/A	28'-10"	26'-9"	25'-6"	N/A
	NI-90x	29'-0"	26'-10"	25'-7"	N/A	29'-7"	27'-5"	26'-2"	N/A

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of  $1.50L + 1.25D$ . The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2022.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.



## Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf

Simple Spans, L/480 Deflection Limit

3/4" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-10"	15'-0"	14'-5"	13'-5"	16'-4"	15'-5"	14'-6"	13'-5"
	NI-40x	17'-0"	16'-0"	15'-5"	14'-9"	17'-5"	16'-5"	15'-10"	15'-2"
	NI-60	17'-2"	16'-2"	15'-7"	14'-11"	17'-6"	16'-7"	15'-11"	15'-3"
	NI-70	18'-0"	16'-11"	16'-3"	15'-7"	18'-5"	17'-3"	16'-7"	15'-11"
	NI-80	18'-3"	17'-1"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	16'-1"
11-7/8"	NI-20	17'-10"	16'-10"	16'-2"	15'-6"	18'-6"	17'-4"	16'-9"	16'-1"
	NI-40x	19'-4"	17'-11"	17'-3"	16'-6"	19'-11"	18'-6"	17'-9"	17'-0"
	NI-60	19'-7"	18'-2"	17'-5"	16'-9"	20'-2"	18'-9"	17'-11"	17'-2"
	NI-70	20'-9"	19'-2"	18'-3"	17'-5"	21'-4"	19'-9"	18'-10"	17'-10"
	NI-80	21'-1"	19'-5"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
14"	NI-90x	21'-8"	20'-0"	19'-1"	18'-0"	22'-2"	20'-6"	19'-6"	18'-6"
	NI-40x	21'-5"	19'-10"	18'-11"	17'-11"	22'-1"	20'-6"	19'-7"	18'-7"
	NI-60	21'-10"	20'-2"	19'-3"	18'-2"	22'-5"	20'-10"	19'-11"	18'-10"
	NI-70	23'-0"	21'-3"	20'-3"	19'-2"	23'-8"	21'-11"	20'-10"	19'-9"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
16"	NI-90x	24'-1"	22'-3"	21'-2"	20'-0"	24'-8"	22'-10"	21'-9"	20'-7"
	NI-60	23'-9"	22'-0"	20'-11"	19'-10"	24'-6"	22'-9"	21'-8"	20'-6"
	NI-70	25'-1"	23'-2"	22'-0"	20'-10"	25'-9"	23'-10"	22'-9"	21'-6"
	NI-80	25'-6"	23'-6"	22'-4"	21'-2"	26'-1"	24'-2"	23'-1"	21'-10"
	NI-90x	26'-4"	24'-3"	23'-1"	21'-10"	26'-11"	24'-11"	23'-8"	22'-5"
Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-10"	15'-5"	14'-6"	13'-5"	16'-10"	15'-5"	14'-6"	13'-5"
	NI-40x	18'-8"	17'-2"	16'-3"	15'-2"	18'-10"	17'-2"	16'-3"	15'-2"
	NI-60	18'-11"	17'-6"	16'-6"	15'-5"	19'-2"	17'-6"	16'-6"	15'-5"
	NI-70	20'-0"	18'-7"	17'-9"	16'-7"	20'-5"	18'-11"	17'-10"	16'-7"
	NI-80	20'-3"	18'-10"	17'-11"	16'-10"	20'-8"	19'-3"	18'-2"	16'-10"
11-7/8"	NI-20	20'-1"	18'-5"	17'-5"	16'-2"	20'-1"	18'-5"	17'-5"	16'-2"
	NI-40x	21'-10"	20'-4"	19'-4"	17'-8"	22'-5"	20'-6"	19'-4"	17'-8"
	NI-60	22'-1"	20'-7"	19'-7"	18'-4"	22'-8"	20'-10"	19'-8"	18'-4"
	NI-70	23'-4"	21'-8"	20'-8"	19'-7"	23'-10"	22'-3"	21'-2"	19'-9"
	NI-80	23'-7"	21'-11"	20'-11"	19'-9"	24'-1"	22'-6"	21'-5"	20'-0"
14"	NI-90x	24'-3"	22'-6"	21'-6"	20'-4"	24'-8"	23'-0"	22'-0"	20'-9"
	NI-40x	24'-5"	22'-9"	21'-8"	19'-5"	25'-1"	23'-2"	21'-9"	19'-5"
	NI-60	24'-10"	23'-1"	22'-0"	20'-10"	25'-6"	23'-8"	22'-4"	20'-10"
	NI-70	26'-1"	24'-3"	23'-2"	21'-10"	26'-8"	24'-11"	23'-9"	22'-4"
	NI-80	26'-6"	24'-7"	23'-5"	22'-2"	27'-1"	25'-3"	24'-1"	22'-9"
16"	NI-90x	27'-3"	25'-4"	24'-1"	22'-9"	27'-9"	25'-11"	24'-8"	23'-4"
	NI-60	27'-3"	25'-5"	24'-2"	22'-10"	28'-0"	26'-2"	24'-9"	23'-1"
	NI-70	28'-8"	26'-8"	25'-4"	23'-11"	29'-3"	27'-4"	26'-1"	24'-8"
	NI-80	29'-1"	27'-0"	25'-9"	24'-4"	29'-8"	27'-9"	26'-5"	25'-0"
	NI-90x	29'-11"	27'-10"	26'-6"	25'-0"	30'-6"	28'-5"	27'-2"	25'-8"

1. Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.

2. Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.

3. Minimum bearing length shall be 1-3/4 inches for the end bearings.

4. Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.

5. This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.

6. Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.