

SITE NAME: RUSSEL GARDENS PHASE 3

LOT 19

DATE: Aug-20

WINTER NATURAL AIR CHANGE RATE 0.366

HEAT LOSS AT °F. 71

CSA-F280-12

BUILDER: GREENPARK HOMES

TYPE: MOUNTAINASH 8

GFA: 3325

LOF: 87263

SUMMER NATURAL AIR CHANGE RATE 0.127

HEAT GAIN AT °F. 13

SB-12 PACKAGE A1

ROOM USE		MBR	ENS	WIC	BED-3	BED-4	BED-5	ENS-3	BED-2	WIC-4	ENS-2		
EXP. WALL		33	30	7	27	37	12	6	11	5	6		
CLG. HT.		9	9	9	9	9	9	9	9	9	9		
GRS.WALL AREA	FACTORS	297	270	63	248	333	108	64	99	46	54		
GLAZING	LOSS GAIN	LOSS GAIN	LOSS GAIN	LOSS GAIN	LOSS GAIN	LOSS GAIN	LOSS GAIN	LOSS GAIN	LOSS GAIN	LOSS GAIN	LOSS GAIN		
NORTH	19.8 18.0	0 0 0	7 138 112	0 0 0	13 267 208	0 0 0	0 0 0	7 138 112	16 316 259	0 0 0	0 0 0		
EAST	19.8 41.6	0 0 0	0 0 0	0 0 0	48 949 1584	82 1226 2576	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0		
SOUTH	19.8 24.9	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	16 316 388	0 0 0	0 0 0	0 0 0	7 138 174		
WEST	19.8 41.6	32 633 1330	14 277 882	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0		
SKYL.T.	34.6 101.5	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0		
DOORS	23.6 4.3	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0		
NET EXPOSED WALL	4.1 0.8	285 1099 199	249 1032 187	63 201 47	182 765 137	271 1123 204	92 391 69	47 195 35	83 344 62	45 187 34	47 195 35		
NET EXPOSED BSMT WALL ABOVE GR	3.3 0.6	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0		
EXPOSED CLG	1.2 0.6	287 342 189	221 283 130	140 167 82	236 281 139	183 218 108	189 216 108	66 79 39	220 282 129	40 48 24	72 86 42		
NO ATTIC EXPOSED CLG	2.6 1.3	0 0 0	0 0 0	0 0 0	16 41 20	45 115 67	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0		
EXPOSED FLOOR	2.4 0.4	0 0 0	0 0 0	0 0 0	241 571 104	0 0 0	0 0 0	66 161 29	69 163 30	40 95 17	0 0 0		
BASEMENT/CRAWL HEAT LOSS		0	0	0	0	0	0	0	0	0	0		
SLAB ON GRADE HEAT LOSS		0	0	0	0	0	0	0	0	0	0		
SUBTOTAL HT LOSS		2073	1711	428	2854	2682	912	573	1086	329	419		
SUB TOTAL HT GAIN		1897	1011	130	2801	2944	573	215	477	76	262		
LEVEL FACTOR / MULTIPLIER	0.20 0.28		0.20 0.28	0.20 0.28	0.20 0.28	0.20 0.28	0.20 0.28	0.20 0.28	0.20 0.28	0.20 0.28	0.20 0.28		
AIR CHANGE HEAT LOSS	582		480	129	801	763	206	161	305	92	118		
AIR CHANGE HEAT GAIN	128		76	10	197	223	43	16	36	6	19		
DUCT LOSS	0		0	0	366	0	0	73	139	42	0		
DUCT GAIN	0		0	0	368	0	0	23	141	8	0		
HEAT GAIN PEOPLE	240	2	480	0	1	240	1	240	0	1	0		
HEAT GAIN APPLIANCES/LIGHTS	655		655	0	655	655	655	0	655	0	0		
TOTAL HT LOSS BTU/H		2665	2191	548	4020	3435	1168	807	1630	463	537		
TOTAL HT GAIN x 1.3 BTU/H		3849	1413	181	5261	5280	1965	331	2013	115	362		

ROOM USE		FAM	LJD	K/B	L/H	LND	W/R	FOY	MUD			WOB	BAS
EXP. WALL		36	30	37	19	12	18	18	30			46	134
CLG. HT.		10	10	10	10	9	10	10	11			8	8
GRS.WALL AREA	FACTORS	360	300	370	180	108	180	180	330			368	737
GLAZING	LOSS GAIN	LOSS GAIN	LOSS GAIN	LOSS GAIN	LOSS GAIN	LOSS GAIN	LOSS GAIN	LOSS GAIN	LOSS GAIN			LOSS GAIN	LOSS GAIN
NORTH	19.8 18.0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	7 138 112			0 0 0	3 59 48
EAST	19.8 41.6	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	22 436 914	8 119 249	0 0 0			0 0 0	0 0 0
SOUTH	19.8 24.9	0 0 0	40 791 986	0 0 0	13 287 324	7 138 174	0 0 0	0 0 0	0 0 0			0 0 0	6 119 149
WEST	19.8 41.6	40 791 1662	0 0 0	40 791 1662	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0			59 1185 2482	0 0 0
SKYL.T.	34.6 101.5	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0			0 0 0	0 0 0
DOORS	23.6 4.3	0 0 0	0 0 0	20 459 85	0 0 0	0 0 0	0 0 0	40 938 170	0 0 0			20 489 85	20 489 85
NET EXPOSED WALL	4.1 0.8	320 1327 241	260 1076 195	310 1285 233	177 734 133	101 419 78	158 655 119	134 558 101	323 1339 243			289 1198 217	0 0 0
NET EXPOSED BSMT WALL ABOVE GR	3.3 0.6	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0			0 0 0	335 1120 203
EXPOSED CLG	1.2 0.6	0 0 0	0 0 0	0 0 0	0 0 0	180 215 105	0 0 0	0 0 0	0 0 0			0 0 0	0 0 0
NO ATTIC EXPOSED CLG	2.6 1.3	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0			0 0 0	0 0 0
EXPOSED FLOOR	2.4 0.4	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0			0 0 0	0 0 0
BASEMENT/CRAWL HEAT LOSS		0	0	0	0	0	0	0	0			0	2315
SLAB ON GRADE HEAT LOSS		0	0	0	0	0	0	0	0			616	
SUBTOTAL HT LOSS		2117	1869	2545	991	772	1090	1612	1477			3449	4082
SUB TOTAL HT GAIN		1903	1161	1980	467	366	1033	920	365			2754	485
LEVEL FACTOR / MULTIPLIER	0.30 0.60		0.30 0.60	0.30 0.60	0.30 0.60	0.20 0.28	0.30 0.60	0.30 0.60	0.30 0.60			0.50 1.20	
AIR CHANGE HEAT LOSS	1084		931	1287	483	217	543	803	738				8712
AIR CHANGE HEAT GAIN	144		90	180	35	27	78	39	27				245
DUCT LOSS	0		0	0	0	0	0	0	0				0
DUCT GAIN	0		0	0	0	0	0	0	0				0
HEAT GAIN PEOPLE	240	0	0	0	0	0	0	0	0			0	0
HEAT GAIN APPLIANCES/LIGHTS	655		655	655	655	655	655	0	0			0	655
TOTAL HT LOSS BTU/H		3172	2789	3812	1484	988	1633	2415	2213			3449	13794
TOTAL HT GAIN x 1.3 BTU/H		3512	2517	3820	1490	1349	1444	727	496			3580	1801

TOTAL HEAT GAIN BTU/H:

41648

TONS: 3.47

LOSS DUE TO VENTILATION LOAD BTU/H: 1919

STRUCTURAL HEAT LOSS: 53116

TOTAL COMBINED HEAT LOSS BTU/H: 84934

SITE NAME: RUSSEL GARDENS PHASE 3
BUILDER: GREENPARK HOMES

LOT 19
TYPE: MOUNTAINASH 5

DATE: Aug-20

GFA: 3325 LO# 87203

HEATING CFM 1504 COOLING CFM 1504
TOTAL HEAT LOSS 53,115 TOTAL HEAT GAIN 41,316
AIR FLOW RATE CFM 28.32 AIR FLOW RATE CFM 36.4

furnace pressure 0.8
furnace filter 0.05
a/c coil pressure 0.2
available pressure for s/a & r/a 0.35

#*GOODMAN
GMEC980804CNA 80
FAN SPEED LOW 868
MEDLOW 978
MEDIUM 1112
MEDIUM HIGH 1504
HIGH 1615

AFUE = 96 %
INPUT (BTU/H) = 80,000
OUTPUT (BTU/H) = 76,800
DESIGN CFM = 1504
CFM @ 0.1" E.S.P.

RUN COUNT	4th	3rd	2nd	1st	Bas
S/A	0	0	14	9	5
R/A	0	0	6	3	1

All S/A diffusers 4"x10" unless noted otherwise on layout.

All S/A runs 5"Ø unless noted otherwise on layout.

RUN #	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
ROOM NAME	MBR	ENS	WIC	BED-3	BED-4	BED-5	ENS-3	BED-2	WIC-4	MBR	ENS-2	FAM	L/D	K/B	K/B	L/H	LND	W/R	FOY	MUD	BAS	BAS	BAS	BAS
RM LOSS MBH	1.33	2.19	0.55	2.01	1.72	1.17	0.81	1.53	0.46	1.33	0.54	1.59	2.80	1.91	1.91	1.48	0.99	1.63	2.42	2.21	3.45	3.45	3.45	3.45
CFM PER RUN HEAT	38	62	16	57	49	33	23	43	13	38	15	45	79	54	54	42	28	46	68	63	98	98	98	98
RM GAIN MBH	1.92	1.41	0.18	2.64	2.64	1.96	0.33	2.01	0.11	1.92	0.35	1.76	2.52	1.81	1.81	1.49	1.35	1.44	0.73	0.50	1.08	1.08	1.08	1.08
CFM PER RUN COOLING	70	51	7	96	96	72	12	73	4	70	13	64	92	66	66	54	49	53	26	18	39	39	39	39
ADJUSTED PRESSURE	0.17	0.17	0.17	0.16	0.16	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.16	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.16	0.16	0.16	0.16
ACTUAL DUCT LGH	37	54	39	59	56	34	51	45	39	39	22	10	40	31	27	20	33	41	44	57	38	5	31	31
EQUIVALENT LENGTH	190	130	150	130	170	200	220	160	110	130	150	140	130	150	160	140	180	110	90	140	140	140	140	130
TOTAL EFFECTIVE LENGTH	227	184	189	189	226	234	254	211	155	169	189	162	140	190	191	167	200	143	131	184	197	178	145	161
ADJUSTED PRESSURE	0.08	0.09	0.09	0.09	0.07	0.07	0.07	0.08	0.11	0.1	0.09	0.11	0.12	0.09	0.09	0.1	0.09	0.12	0.13	0.09	0.08	0.09	0.11	0.1
ROUND DUCT SIZE	5	5	4	6	6	6	4	6	4	5	4	5	5	5	5	5	5	4	5	5	6	6	6	6
HEATING VELOCITY (ft/min)	279	455	184	291	250	168	264	219	149	279	172	330	580	396	396	308	206	528	499	463	500	500	500	500
COOLING VELOCITY (ft/min)	514	374	80	489	489	367	138	372	46	514	149	470	675	485	485	396	360	608	191	132	198	198	198	198
OUTLET GRILL SIZE	3X10	3X10	3X10	4X10	4X10	4X10	3X10	4X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	4X10	4X10	4X10	4X10
TRUNK	B	A	B	D	C	C	C	A	D	B	D	B	D	A	A	C	B	C	C	A	A	B	D	C

RUN #	25	26	27	28
ROOM NAME	BED-3	BED-4	FAM	BAS
RM LOSS MBH	2.01	1.72	1.59	3.45
CFM PER RUN HEAT	57	49	45	98
RM GAIN MBH	2.64	2.64	1.76	1.08
CFM PER RUN COOLING	96	96	64	39
ADJUSTED PRESSURE	0.16	0.16	0.17	0.16
ACTUAL DUCT LGH	52	48	28	30
EQUIVALENT LENGTH	120	170	180	190
TOTAL EFFECTIVE LENGTH	172	218	208	220
ADJUSTED PRESSURE	0.09	0.07	0.08	0.07
ROUND DUCT SIZE	6	6	5	6
HEATING VELOCITY (ft/min)	291	250	330	500
COOLING VELOCITY (ft/min)	489	489	470	199
OUTLET GRILL SIZE	4X10	4X10	3X10	4X10
TRUNK	D	C	B	A

SUPPLY AIR TRUNK SIZE										RETURN AIR TRUNK SIZE									
TRUNK	STATIC	ROUND	RECT	VELOCITY	TRUNK	STATIC	ROUND	RECT	VELOCITY	TRUNK	STATIC	ROUND	RECT	VELOCITY	TRUNK	STATIC	ROUND	RECT	VELOCITY
CFM	PRESS.	DUCT	DUCT	(ft/min)	CFM	PRESS.	DUCT	DUCT	(ft/min)	CFM	PRESS.	DUCT	DUCT	(ft/min)	CFM	PRESS.	DUCT	DUCT	(ft/min)
TRUNK A	472	0.07	10.9	14	x	8	607			TRUNK G	0	0.00	0	0	x	8	0		
TRUNK B	780	0.07	13.2	20	x	8	702			TRUNK H	0	0.00	0	0	x	8	0		
TRUNK C	408	0.07	10.4	12	x	8	612			TRUNK I	0	0.00	0	0	x	8	0		
TRUNK D	727	0.07	12.9	20	x	8	654			TRUNK J	0	0.00	0	0	x	8	0		
TRUNK E	0	0.00	0	0	x	8	0			TRUNK K	0	0.00	0	0	x	8	0		
TRUNK F	0	0.00	0	0	x	8	0			TRUNK L	0	0.00	0	0	x	8	0		

RETURN AIR #	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
AIR VOLUME	95	85	95	95	85	75	425	130	200	0	0	0	0	0	0	0	0	0	0	219				
PLENUM PRESSURE	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15					
ACTUAL DUCT LGH	41	52	53	58	53	59	45	41	24	1	1	1	1	1	1	1	1	1	1	15				
EQUIVALENT LENGTH	185	195	185	185	215	265	185	180	135	0	0	0	0	0	0	0	0	0	0	150				
TOTAL EFFECTIVE LH	226	247	218	223	268	324	210	231	159	1	1	1	1	1	1	1	1	1	1	185				
ADJUSTED PRESSURE	0.07	0.06	0.07	0.07	0.06	0.05	0.07	0.06	0.09	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	0.09				
ROUND DUCT SIZE	6	6	6	6	6	6	10.5	7	7.5	0	0	0	0	0	0	0	0	0	0	7.7				
INLET GRILL SIZE	8	8	8	8	8	8	8	8	8	0	0	0	0	0	0	0	0	0	0	8				
INLET GRILL SIZE	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X				
INLET GRILL SIZE	14	14	14	14	14	14	30	14	14	0	0	0	0	0	0	0	0	0	0	24				

TYPE: MOUNTAINASH 5
 SITE NAME: RUSSEL GARDENS PHASE 3

 LO # 87203
 LOT 19

RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

COMBUSTION APPLIANCES		9.32.3.1(1)
a) ☒	Direct vent (sealed combustion) only	
b) ☐	Positive venting induced draft (except fireplaces)	
c) ☐	Natural draft, B-vent or induced draft gas fireplace	
d) ☐	Solid Fuel (including fireplaces)	
e) ☐	No Combustion Appliances	

HEATING SYSTEM	
☒	Forced Air
☐	Non Forced Air
☐	Electric Space Heat

HOUSE TYPE		9.32.1(2)
☒	I Type a) or b) appliance only, no solid fuel	
☐	II Type I except with solid fuel (including fireplaces)	
☐	III Any Type c) appliance	
☐	IV Type I, or II with electric space heat	
☐	Other: Type I, II or IV no forced air	

SYSTEM DESIGN OPTIONS		O.N.H.W.P.
☐	1 Exhaust only/Forced Air System	
☐	2 HRV with Ducting/Forced Air System	
☒	3 HRV Simplified/connected to forced air system	
☐	4 HRV with Ducting/non forced air system	
☐	Part 6 Design	

TOTAL VENTILATION CAPACITY		9.32.3.3(1)
Basement + Master Bedroom	2 @ 21.2 cfm	42.4 cfm
Other Bedrooms	4 @ 10.6 cfm	42.4 cfm
Kitchen & Bathrooms	5 @ 10.6 cfm	53 cfm
Other Rooms	7 @ 10.6 cfm	74.2 cfm
Table 9.32.3.A.	TOTAL	212.0 cfm

PRINCIPAL VENTILATION CAPACITY REQUIRED		9.32.3.4.(1)
1 Bedroom	31.8	cfm
2 Bedroom	47.7	cfm
3 Bedroom	63.6	cfm
4 Bedroom	79.5	cfm
5 Bedroom	95.4	cfm
TOTAL	95.4	cfm

SUPPLEMENTAL VENTILATION CAPACITY		9.32.3.5.
Total Ventilation Capacity	212	cfm
Less Principal Ventil. Capacity	95.4	cfm
Required Supplemental Capacity	116.6	cfm

PRINCIPAL EXHAUST FAN CAPACITY			
Model: VANEE 65H	Location: BSMT		
95.4 cfm	3.0 sones		
☒	HVI Approved		
PRINCIPAL EXHAUST HEAT LOSS CALCULATION			
CFM	ΔT °F	FACTOR	% LOSS
95.4 CFM	X 71 F	X 1.08	X 0.25

SUPPLEMENTAL FANS		PANASONIC		
Location	Model	cfm	HVI	Sones
ENS	FV-05-11VK1	50	✓	0.3
ENS-3	FV-05-11VK1	50	✓	0.3
ENS-2	FV-05-11VK1	50	✓	0.3
W/R	FV-05-11VK1	50	✓	0.3

HEAT RECOVERY VENTILATOR		9.32.3.11.
Model: VANEE 65H		
155 cfm high	64 cfm low	
75 % Sensible Efficiency	☒ HVI Approved	
@ 32 deg F (0 deg C)		

LOCATION OF INSTALLATION	
Lot:	Concession
Township	Plan:
Address	
Roll #	Building Permit #

BUILDER: GREENPARK HOMES	
Name:	
Address:	
City:	
Telephone #:	Fax #:

INSTALLING CONTRACTOR	
Name:	
Address:	
City:	
Telephone #:	Fax #:

DESIGNER CERTIFICATION	
I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.	
Name:	HVAC Designs Ltd.
Signature:	<i>Michael O'Rourke</i>
HRAI #	001820
Date:	August-20

I REVIEW AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED IN THE APPROPRIATE CATEGORY AS AN "OTHER DESIGNER" UNDER DIVISION C. 9.2.5 OF THE BUILDING CODE.

INDIVIDUAL BCIN: 19869

MICHAEL O'ROURKE

CSA F280-12 Residential Heat Loss and Heat Gain Calculations																																																																			
Formula Sheet (For Air Leakage / Ventilation Calculation)																																																																			
LO#: 87203		Model: MOUNTAINASH 5		Builder: GREENPARK HOMES			Date: 2020-08-20																																																												
Volume Calculation					Air Change & Delta T Data																																																														
House Volume <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Level</th> <th>Floor Area (ft²)</th> <th>Floor Height (ft)</th> <th>Volume (ft³)</th> </tr> </thead> <tbody> <tr> <td>Bsmt</td> <td>1476</td> <td>8</td> <td>11808</td> </tr> <tr> <td>First</td> <td>1476</td> <td>10</td> <td>14760</td> </tr> <tr> <td>Second</td> <td>1849</td> <td>9</td> <td>16641</td> </tr> <tr> <td>Third</td> <td>0</td> <td>9</td> <td>0</td> </tr> <tr> <td>Fourth</td> <td>0</td> <td>9</td> <td>0</td> </tr> <tr> <td colspan="3" style="text-align: right;">Total:</td> <td>43,209.0 ft³</td> </tr> <tr> <td colspan="3" style="text-align: right;">Total:</td> <td>1223.5 m³</td> </tr> </tbody> </table>					Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)	Bsmt	1476	8	11808	First	1476	10	14760	Second	1849	9	16641	Third	0	9	0	Fourth	0	9	0	Total:			43,209.0 ft³	Total:			1223.5 m³	<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th colspan="2" style="text-align: center;">WINTER NATURAL AIR CHANGE RATE</th> <th>0.356</th> </tr> <tr> <th colspan="2" style="text-align: center;">SUMMER NATURAL AIR CHANGE RATE</th> <th>0.127</th> </tr> </thead> </table> <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th colspan="5" style="text-align: center;">Design Temperature Difference</th> </tr> <tr> <th></th> <th>T_{in} °C</th> <th>T_{out} °C</th> <th>ΔT °C</th> <th>ΔT °F</th> </tr> </thead> <tbody> <tr> <td>Winter DTD_h</td> <td>22</td> <td>-17</td> <td>39</td> <td>71</td> </tr> <tr> <td>Summer DTD_c</td> <td>24</td> <td>31</td> <td>7</td> <td>13</td> </tr> </tbody> </table>					WINTER NATURAL AIR CHANGE RATE		0.356	SUMMER NATURAL AIR CHANGE RATE		0.127	Design Temperature Difference						T _{in} °C	T _{out} °C	ΔT °C	ΔT °F	Winter DTD _h	22	-17	39	71	Summer DTD _c	24	31	7	13
Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)																																																																
Bsmt	1476	8	11808																																																																
First	1476	10	14760																																																																
Second	1849	9	16641																																																																
Third	0	9	0																																																																
Fourth	0	9	0																																																																
Total:			43,209.0 ft³																																																																
Total:			1223.5 m³																																																																
WINTER NATURAL AIR CHANGE RATE		0.356																																																																	
SUMMER NATURAL AIR CHANGE RATE		0.127																																																																	
Design Temperature Difference																																																																			
	T _{in} °C	T _{out} °C	ΔT °C	ΔT °F																																																															
Winter DTD _h	22	-17	39	71																																																															
Summer DTD _c	24	31	7	13																																																															
5.2.3.1 Heat Loss due to Air Leakage					6.2.6 Sensible Gain due to Air Leakage																																																														
$HL_{airb} = LR_{airh} \times \frac{V_b}{3.6} \times DTD_h \times 1.2$ 0.356 x 339.87 x 39 °C x 1.2 = 5693 W = 19424 Btu/h					$HG_{sub} = LR_{airc} \times \frac{V_h}{3.6} \times DTD_c \times 1.2$ = 0.127 x 339.87 x 7 °C x 1.2 = 369 W = 1261 Btu/h																																																														
5.2.3.2 Heat Loss due to Mechanical Ventilation					6.2.7 Sensible heat Gain due to Ventilation																																																														
$HL_{pairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$ 95 CFM x 71 °F x 1.08 x 0.25 = 1819 Btu/h					$HL_{pairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$ 95 CFM x 13 °F x 1.08 x 0.25 = 330 Btu/h																																																														
5.2.3.3 Calculation of Air Change Heat Loss for Each Room (Floor Multiplier Section)																																																																			
$HL_{airv} = Level\ Factor \times HL_{airbv} \times \{(HL_{agcr} + HL_{bgcr}) \div (HL_{agclevel} + HL_{bgclevel})\}$ <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Level</th> <th>Level Factor (LF)</th> <th>HL_{airbv} Air Leakage + Ventilation Heat Loss (Btu/h)</th> <th>Level Conductive Heat Loss: (HL_{clevel})</th> <th>Air Leakage Heat Loss Multiplier (LF x HL_{airbv} / HL_{clevel})</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>0.5</td> <td rowspan="5" style="text-align: center;">19,424</td> <td>7,530</td> <td>1.290</td> </tr> <tr> <td>2</td> <td>0.3</td> <td>11,701</td> <td>0.498</td> </tr> <tr> <td>3</td> <td>0.2</td> <td>13,839</td> <td>0.281</td> </tr> <tr> <td>4</td> <td>0</td> <td>0</td> <td>0.000</td> </tr> <tr> <td>5</td> <td>0</td> <td>0</td> <td>0.000</td> </tr> </tbody> </table>										Level	Level Factor (LF)	HL _{airbv} Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{clevel})	Air Leakage Heat Loss Multiplier (LF x HL _{airbv} / HL _{clevel})	1	0.5	19,424	7,530	1.290	2	0.3	11,701	0.498	3	0.2	13,839	0.281	4	0	0	0.000	5	0	0	0.000																																
Level	Level Factor (LF)	HL _{airbv} Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{clevel})	Air Leakage Heat Loss Multiplier (LF x HL _{airbv} / HL _{clevel})																																																															
1	0.5	19,424	7,530	1.290																																																															
2	0.3		11,701	0.498																																																															
3	0.2		13,839	0.281																																																															
4	0		0	0.000																																																															
5	0		0	0.000																																																															
*HL_{airbv} = Air leakage heat loss + ventilation heat loss *For a balanced or supply only ventilation system HL_{airv} = 0																																																																			

HEAT LOSS AND GAIN SUMMARY SHEET

MODEL: MOUNTAINASH 5	LOT 19	BUILDER: GREENPARK HOMES
SFQT: 3325	LO# 87203	SITE: RUSSEL GARDENS PHASE 3

DESIGN ASSUMPTIONS

HEATING	°F	COOLING	°F
OUTDOOR DESIGN TEMP.	1	OUTDOOR DESIGN TEMP.	88
INDOOR DESIGN TEMP.	72	INDOOR DESIGN TEMP. (MAX 75°F)	75

BUILDING DATA

ATTACHMENT:	DETACHED	# OF STORIES (+BASEMENT):	3
FRONT FACES:	EAST	ASSUMED (Y/N):	Y
AIR CHANGES PER HOUR:	3.57	ASSUMED (Y/N):	Y
AIR TIGHTNESS CATEGORY:	AVERAGE	ASSUMED (Y/N):	Y
WIND EXPOSURE:	SHELTERED	ASSUMED (Y/N):	Y
HOUSE VOLUME (ft³):	43209.0	ASSUMED (Y/N):	Y
INTERNAL SHADING:	BLINDS/CURTAINS	ASSUMED OCCUPANTS:	6
INTERIOR LIGHTING LOAD (Btu/h/ft²):	1.50	DC BRUSHLESS MOTOR (Y/N):	Y
FOUNDATION CONFIGURATION	BCIN_1	DEPTH BELOW GRADE:	5.5 ft
LENGTH: 54.0 ft	WIDTH: 36.0 ft	EXPOSED PERIMETER:	134.0 ft
WOB INSULATION CONFIGURATION	SCB_9	WOB EXPOSED PERIMETER	46.0 ft

2012 OBC - COMPLIANCE PACKAGE

Component	Compliance Package A1	
	Nominal	Min. Eff.
Ceiling with Attic Space Minimum RSI (R)-Value	60	59.22
Ceiling Without Attic Space Minimum RSI (R)-Value	31	27.65
Exposed Floor Minimum RSI (R)-Value	31	29.80
Walls Above Grade Minimum RSI (R)-Value	22	17.03
Basement Walls Minimum RSI (R)-Value	20 ci	21.12
Below Grade Slab Entire surface > 600 mm below grade Minimum RSI (R)-Value	-	-
Edge of Below Grade Slab ≤ 600 mm Below Grade Minimum RSI (R)-Value	10	10
Heated Slab or Slab ≤ 600 mm below grade Minimum RSI (R)-Value	10	11.13
Windows and Sliding Glass Doors Maximum U-Value	0.28	-
Skylights Maximum U-Value	0.49	-
Space Heating Equipment Minimum AFUE	0.96	-
HRV Minimum Efficiency	75%	-
Domestic Hot Water Heater Minimum EF	0.8	-


INDIVIDUAL BCIN: 19669

MICHAEL O'ROURKE



Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

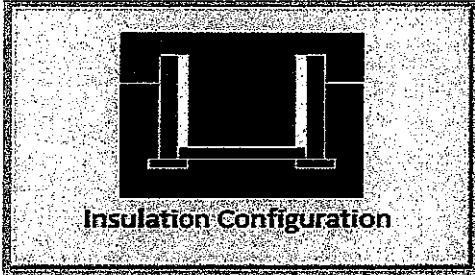
Weather Station Description		
Province:	Ontario	
Region:	Hamilton	
Site Description		
Soil Conductivity:	Normal conductivity: dry sand, loam, clay	
Water Table:	Normal (7-10 m, 23-33 ft)	
Foundation Dimensions		
Floor Length (m):	4.6	 Insulation Configuration
Floor Width (m):	11.0	
Exposed Perimeter (m):	40.8	
Wall Height (m):	2.4	
Depth Below Grade (m):	1.42	
Window Area (m ²):	0.8	
Door Area (m ²):	1.9	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):		678

TYPE: MOUNTAINASH 5
LO# 87203

LOT 19

Residential Slab on Grade Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

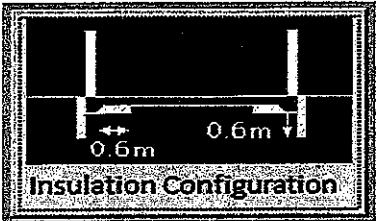Weather Station Description		
Province:	Ontario	
Region:	Hamilton	
Site Description		
Soil Conductivity:	Normal conductivity: dry sand, loam, clay	
Water Table:	Normal (7-10 m, 23-33 ft)	
Foundation Dimensions		
Length (m):	1.5	
Width (m):	11.0	
Exposed Perimeter (m):	14.0	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Results		
Heating Load (Watts):		180

TYPE: MOUNTAINASH 5
LO# 87203

LOT 19


Air Infiltration Residential Load Calculator

Supplemental tool for CAN/CSA-F280

Weather Station Description			
Province:	Ontario		
Region:	Hamilton		
Weather Station Location:	Open flat terrain, grass		
Anemometer height (m):	10		
Local Shielding			
Building Site:	Suburban, forest		
Walls:	Heavy		
Flue:	Heavy		
Highest Ceiling Height (m):	8.23		
Building Configuration			
Type:	Detached		
Number of Stories:	Two		
Foundation:	Full		
House Volume (m ³):	1223.5		
Air Leakage/Ventilation			
Air Tightness Type:	Present (1961-) (3.57 ACH)		
Custom BDT Data:	ELA @ 10 Pa.	1631.0 cm ²	
	3.57	ACH @ 50 Pa	
Mechanical Ventilation (L/s):	Total Supply	Total Exhaust	
	45.0	45.0	
Flue Size			
Flue #:	#1	#2	#3 #4
Diameter (mm):	0	0	0 0
Natural Infiltration Rates			
Heating Air Leakage Rate (ACH/H):	0.356		
Cooling Air Leakage Rate (ACH/H):	0.127		

TYPE: MOUNTAINASH 5
LO# 87203

LOT 19

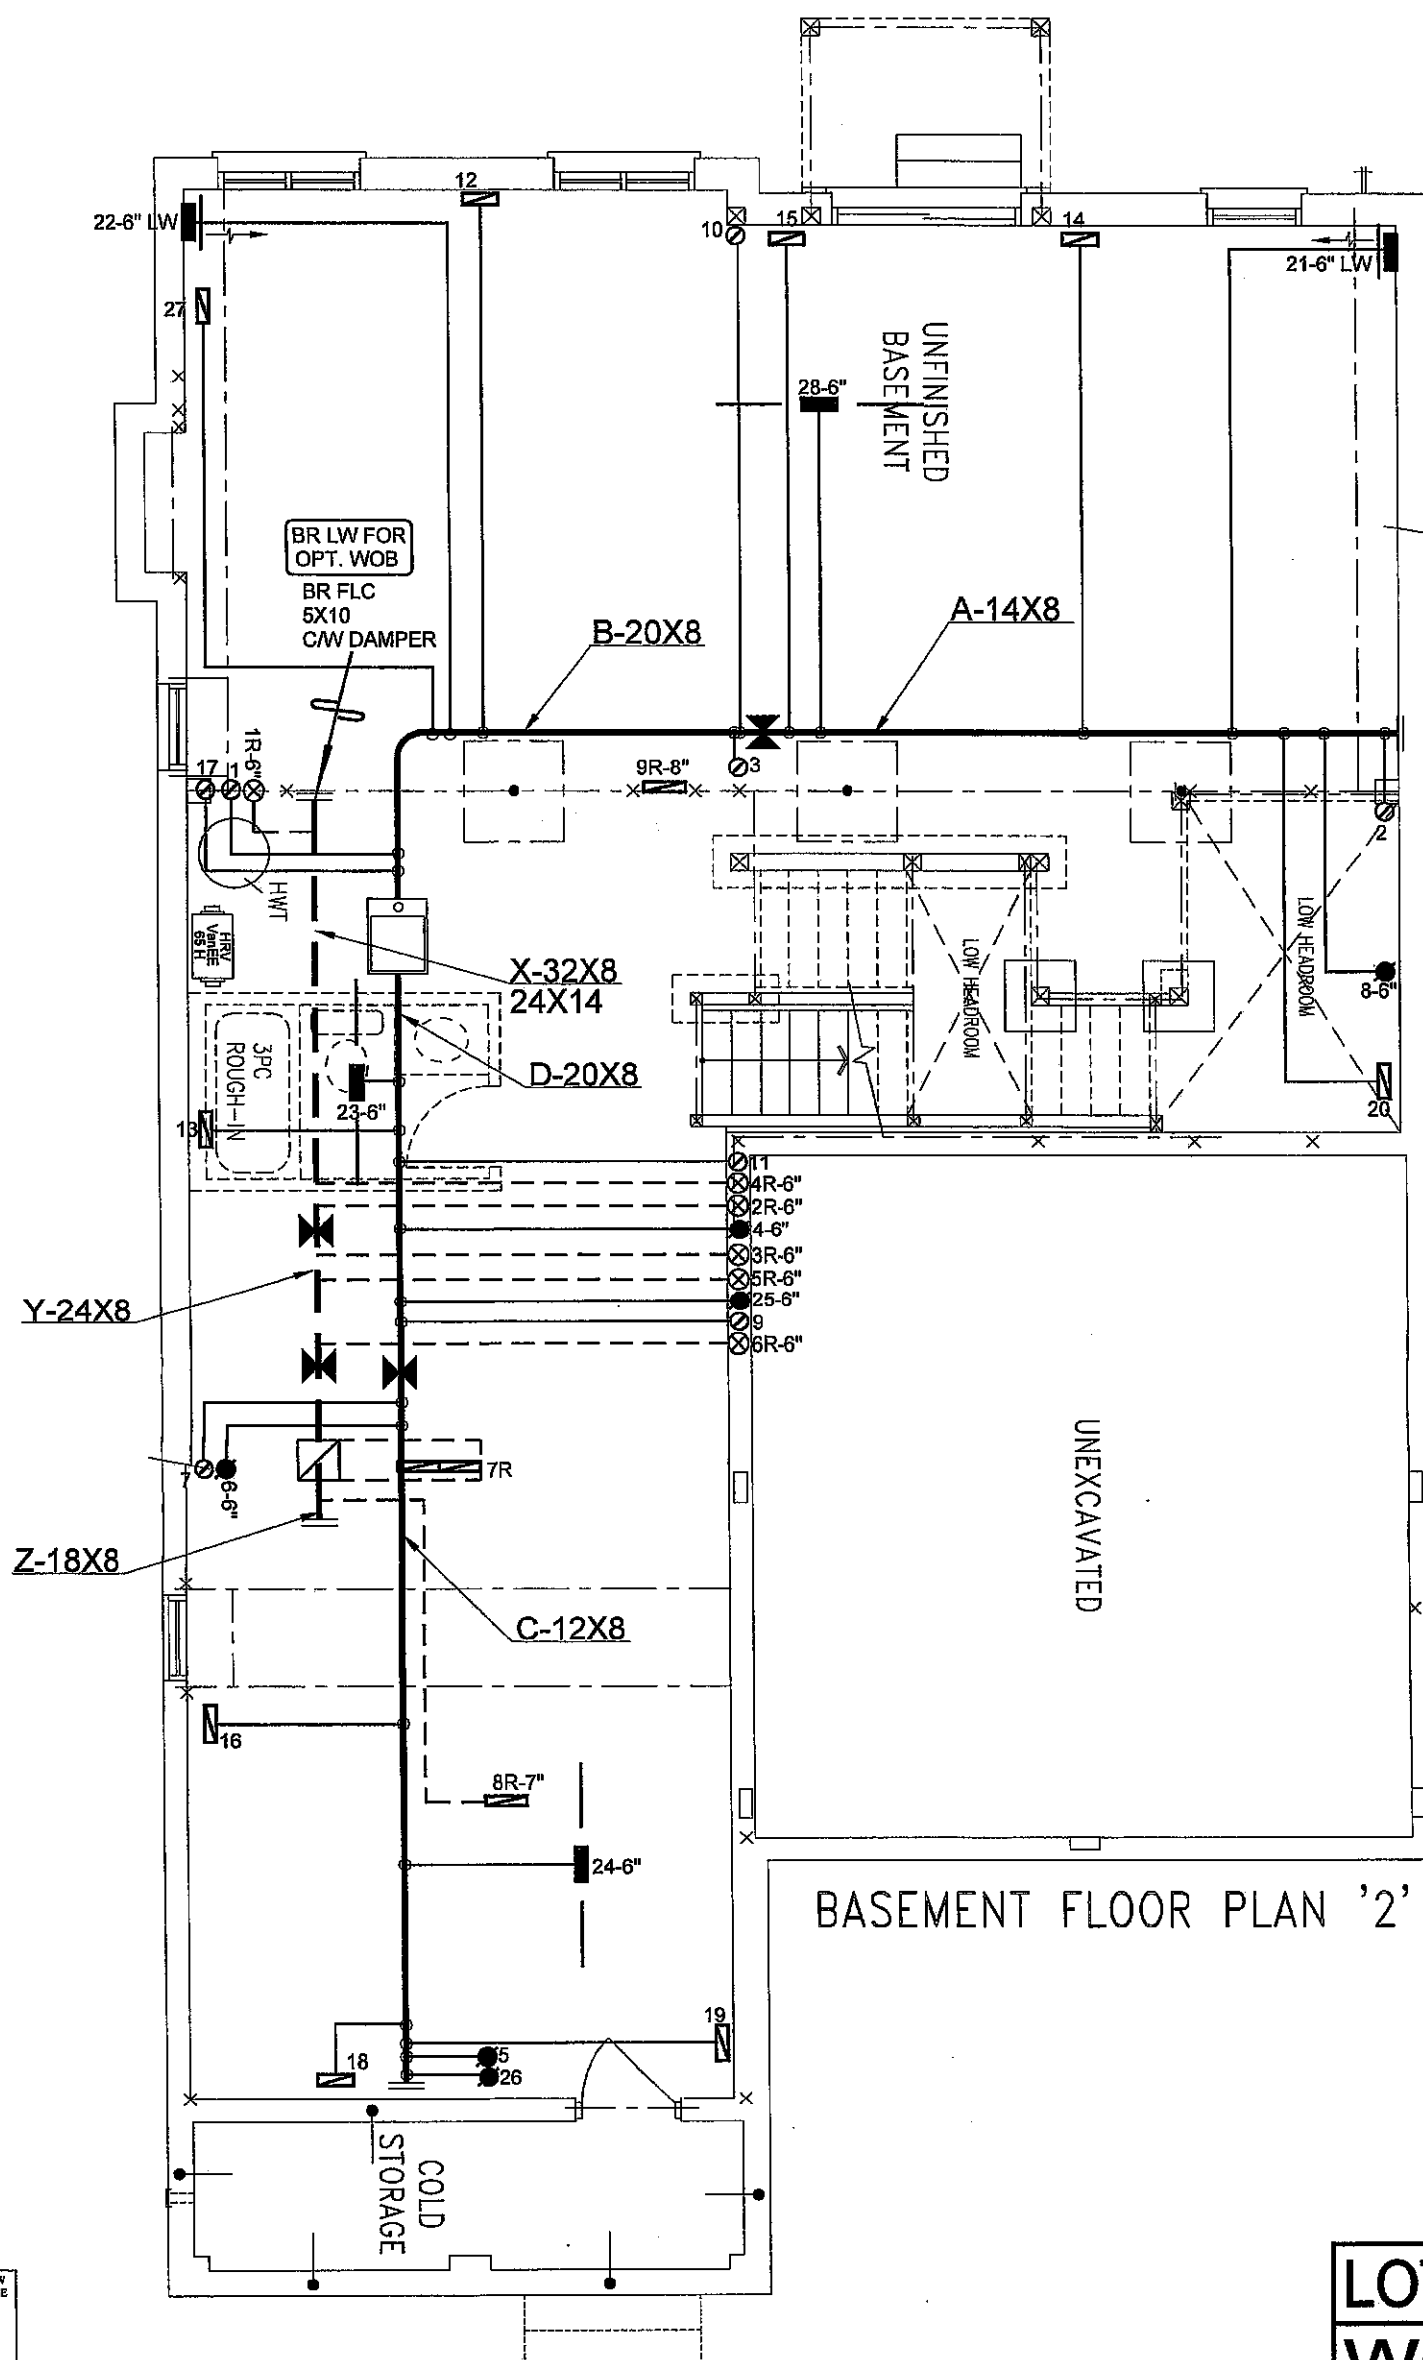

I MICHAEL O'ROURKE HAVE REVIEW
AND TAKE RESPONSIBILITY FOR THE
DESIGN WORK AND AM QUALIFIED
UNDER DIVISION C, 3.2.5 OF THE
BUILDING CODE.


Michael O'Rourke

Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

HVAC DESIGNS LTD.		HVAC LEGEND						3.	
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.	
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.	
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER		Date
								REVISIONS	

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client GREENPARK HOMES		 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdsgns.ca Web: www.hvacdsgns.ca Specializing in Residential Mechanical Design Services	HEAT LOSS 54934 BTU/H UNIT DATA		# OF RUNS S/A R/A FANS			Sheet Title BASEMENT HEATING LAYOUT	
Project Name RUSSEL GARDENS PHASE 3 HAMILTON, ONTARIO			MAKE GOODMAN	3RD FLOOR					Date AUG/2020 Scale 3/16" = 1'-0" BCIN# 19669
			MODEL GMEC960804CNA	2ND FLOOR		14	6	3	
			INPUT 80 MBTUH	1ST FLOOR		9	3	2	
LOT 19 MOUNTAINASH 5 3298 sqft		Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.	OUTPUT 76.8 MBTUH	ALL S/A DIFFUSERS 4 "x10" UNLESS NOTED OTHERWISE ON LAYOUT. ALL S/A RUNS 6"Ø UNLESS NOTED OTHERWISE ON LAYOUT. UNDERCUT DOORS 1" min. FOR R/A					LO# 87203
			COOLING 3.5 TONS						
			FAN SPEED 1504 cfm @ 0.8" w.c.						

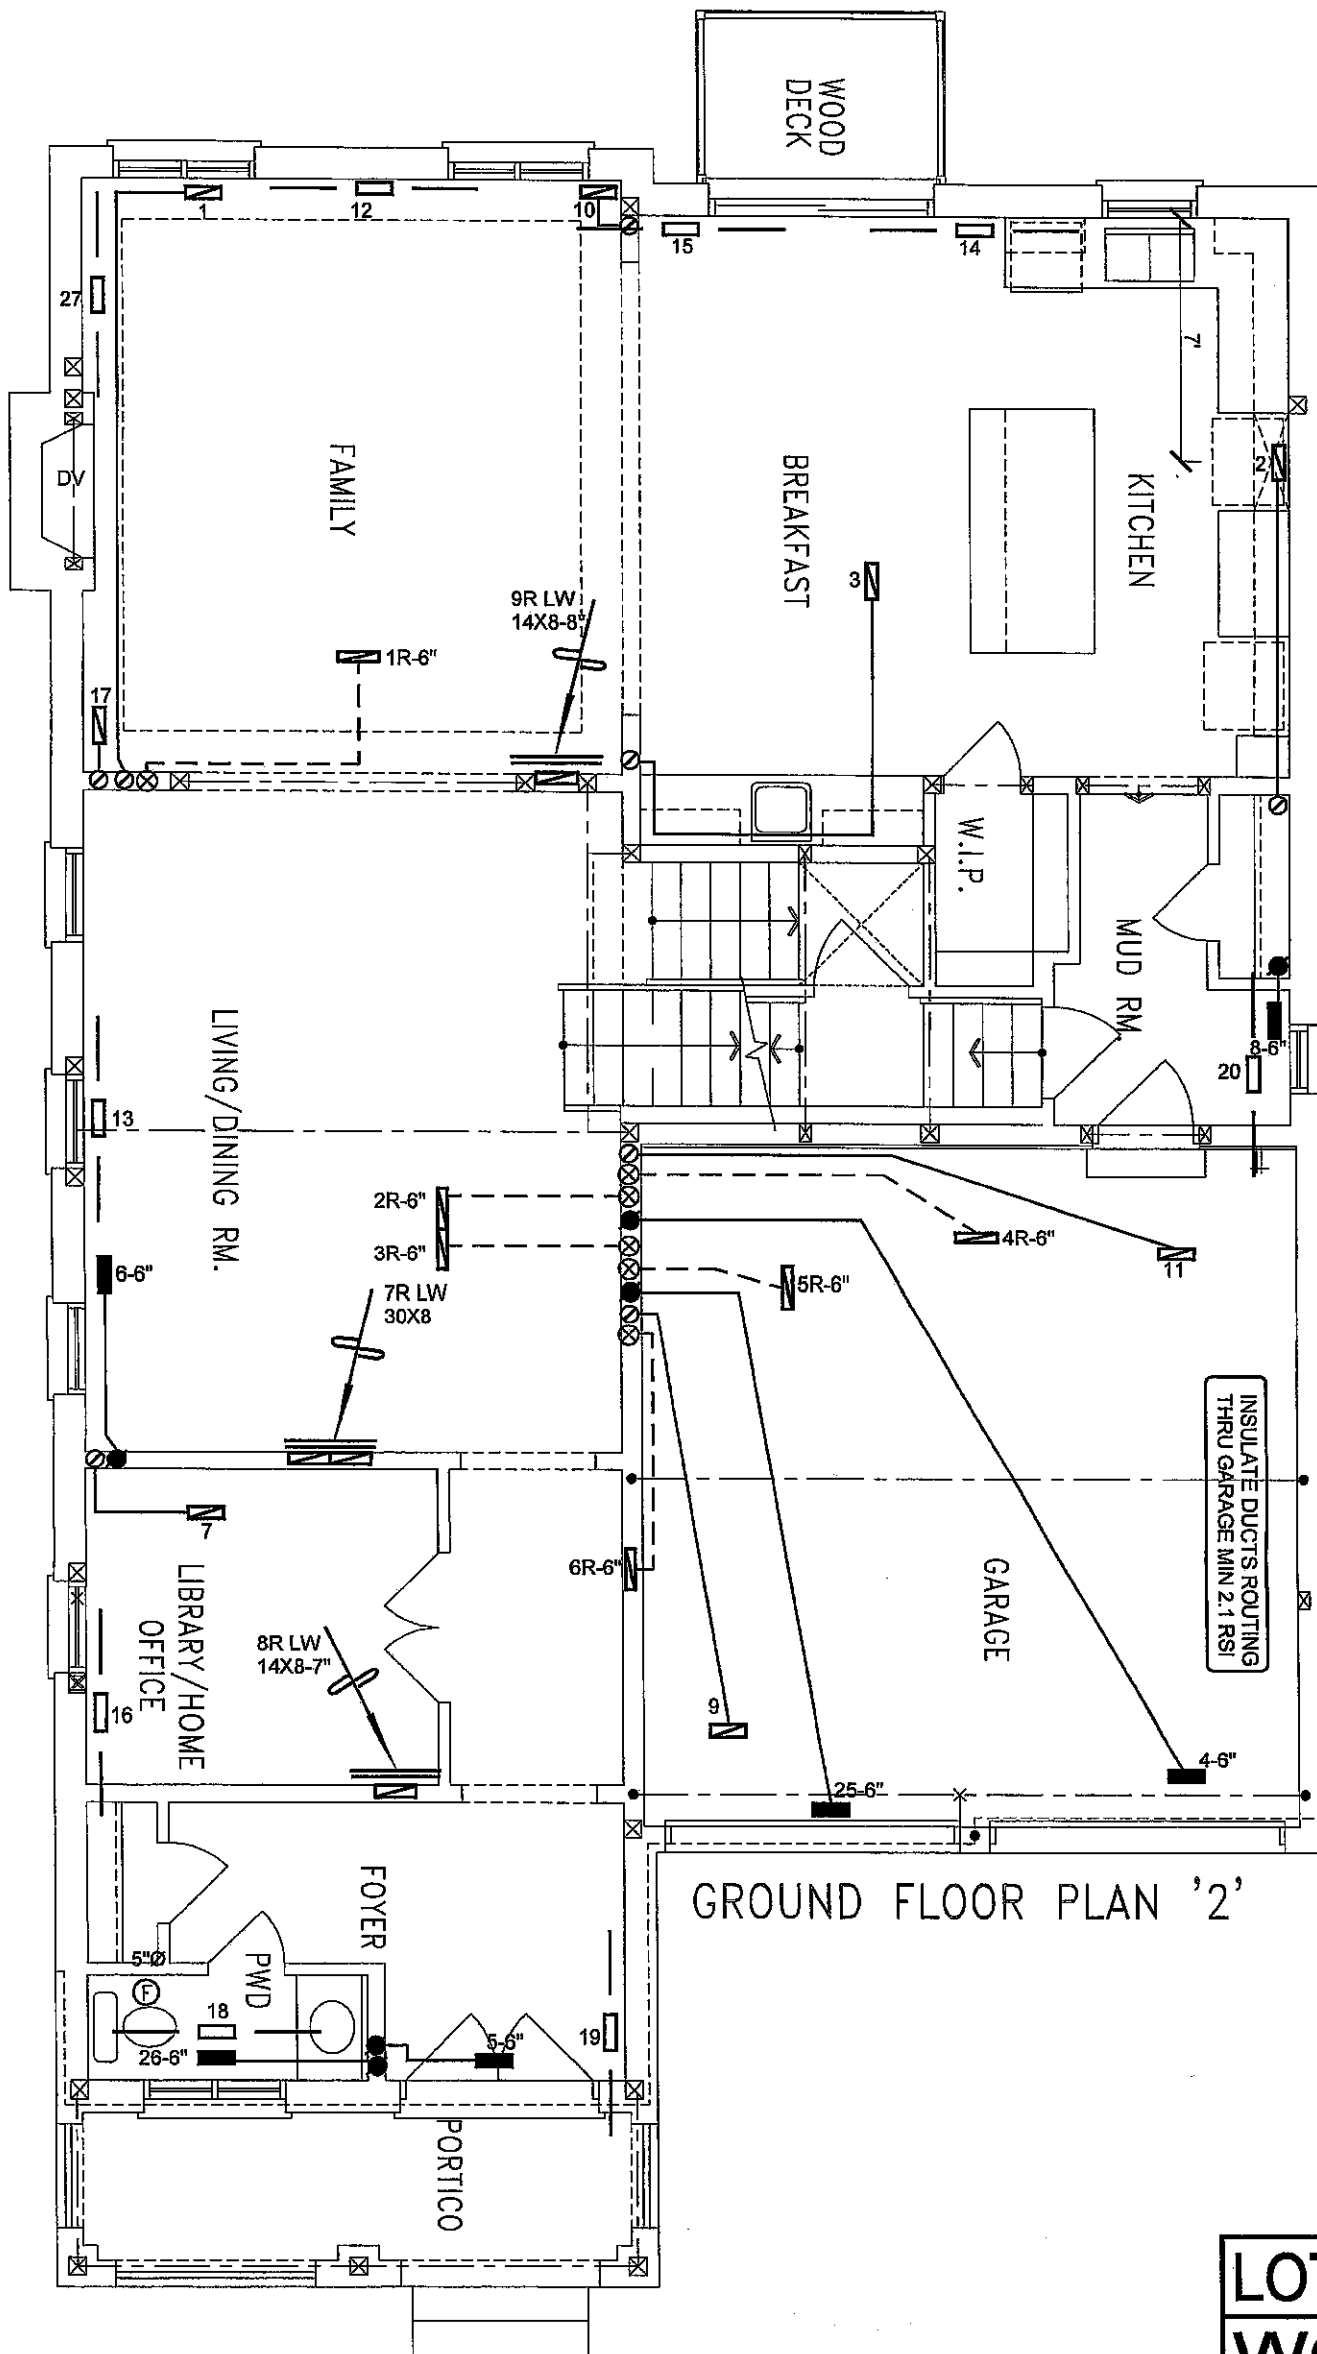

GROUND FLOOR PLAN '2'

I MICHAEL OROZUMI HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C, 32.5 OF THE BUILDING CODE.


Michael Orozumi
Michael Orozumi, BCIN# 19669
HVAC DESIGNS LTD.

LOT 19	CSA-F280-12
WOB	PACKAGE A1

HVAC LEGEND								3.	
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.	
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.	
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description Date
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS	

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client GREENPARK HOMES		 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.	Sheet Title FIRST FLOOR HEATING LAYOUT	
Project Name RUSSEL GARDENS PHASE 3 HAMILTON, ONTARIO			Date AUG/2020	
LOT 19 MOUNTAINASH 5 3298 sqft			Scale 3/16" = 1'-0"	
			BCIN# 19669	
			LO# 87203	

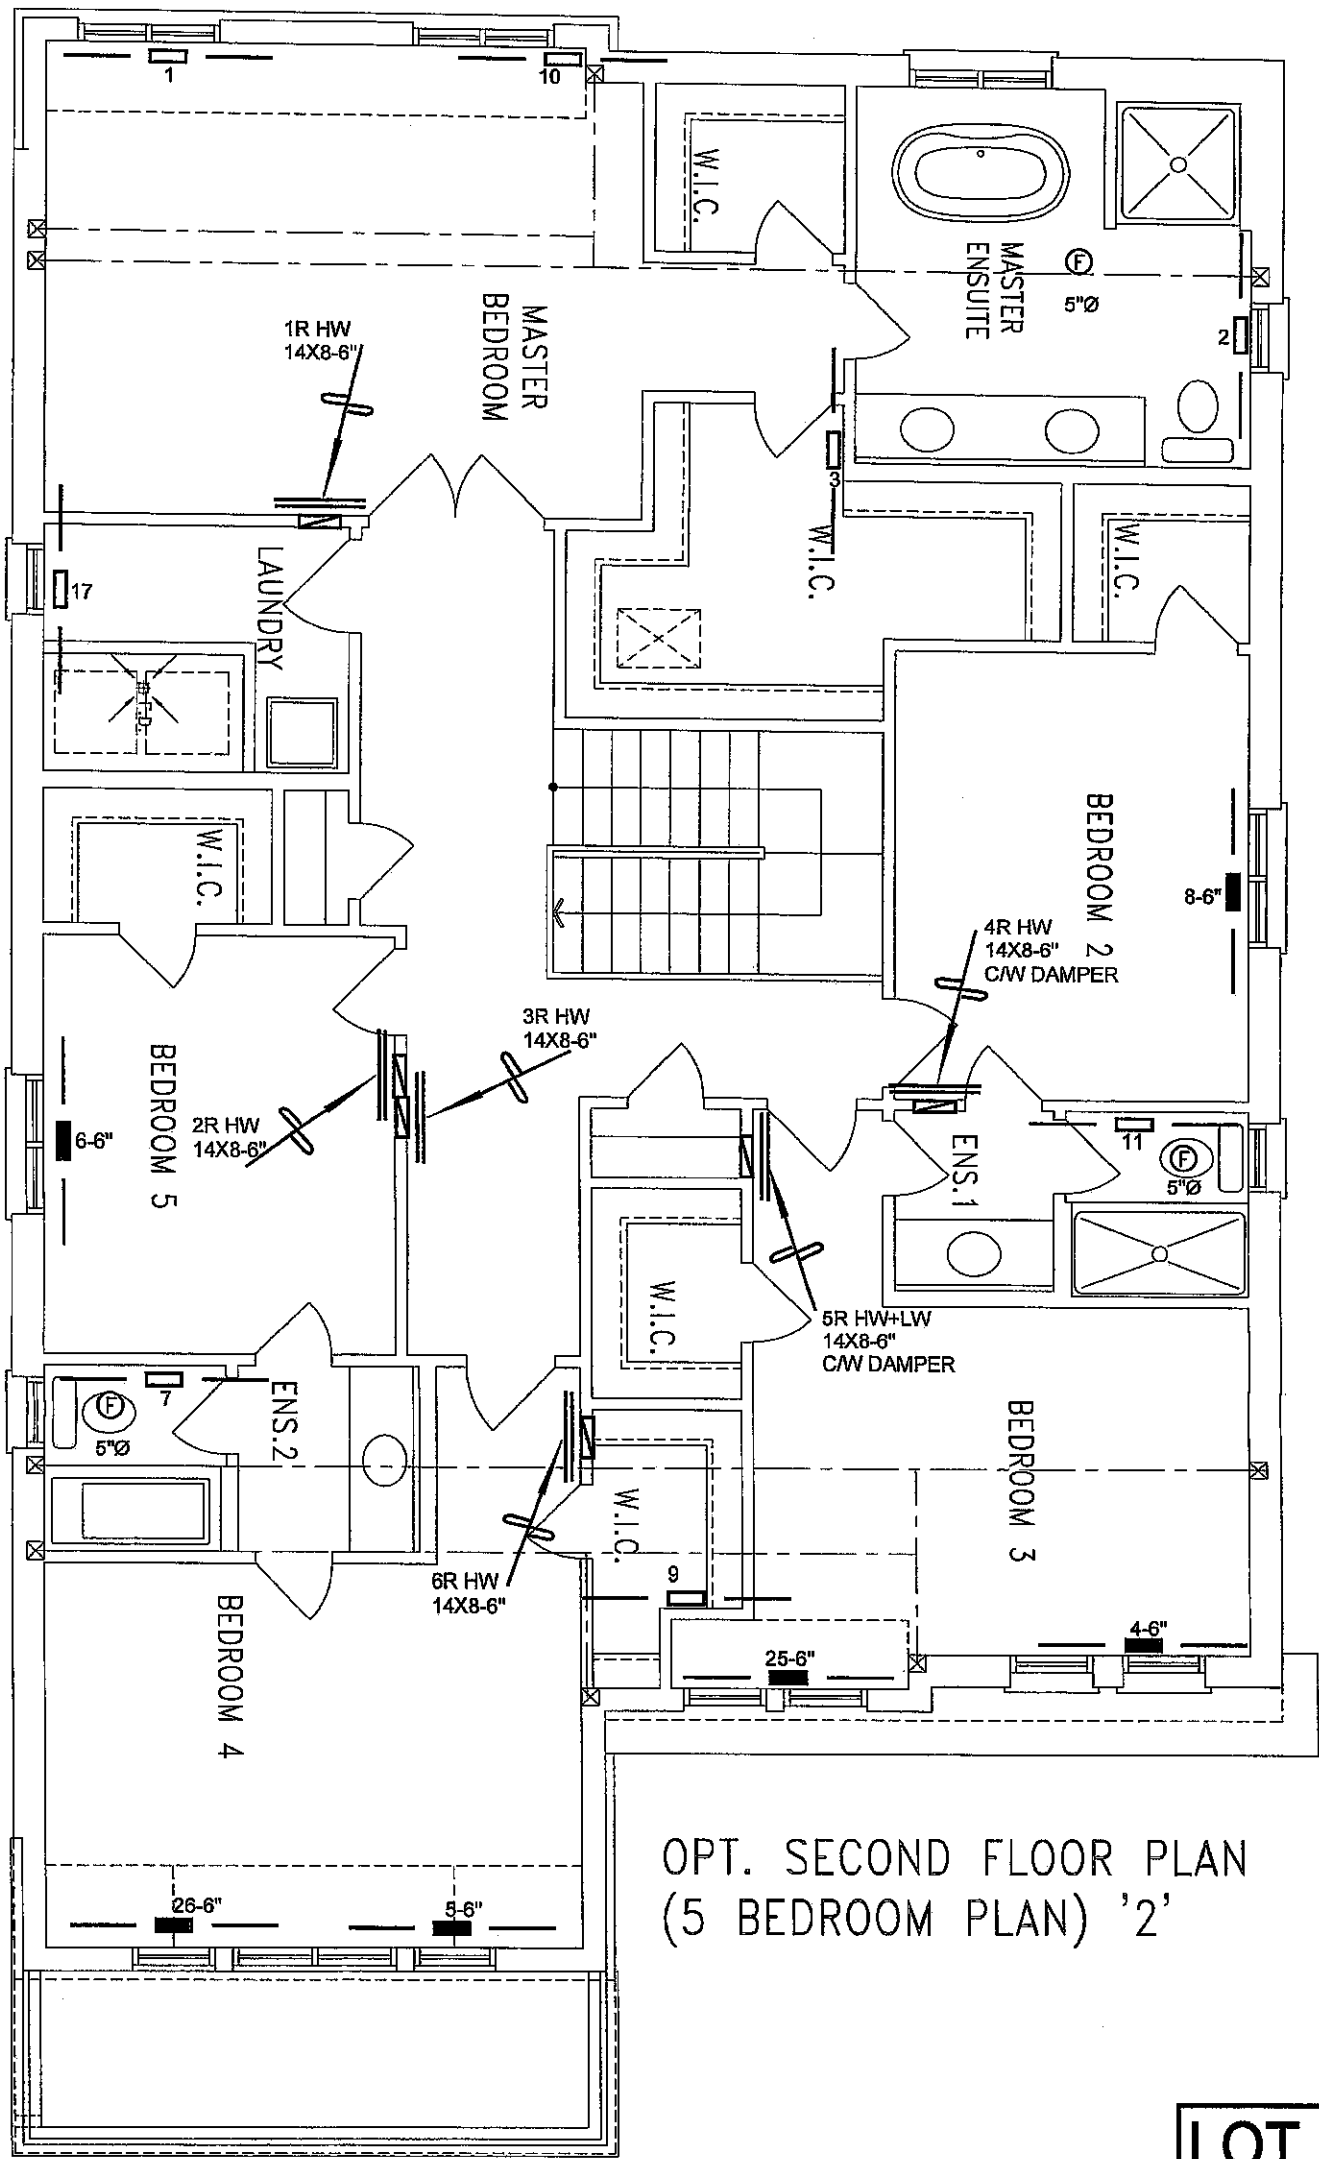

OPT. SECOND FLOOR PLAN
(5 BEDROOM PLAN) '2'

I MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C.32.5 OF THE BUILDING CODE.
Michael O'Rourke
Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

LOT 19 CSA-F280-12
WOB PACKAGE A1

HVAC LEGEND								3.	
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.	
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.	
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description Date
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS	

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client GREENPARK HOMES		 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.	Sheet Title SECOND FLOOR HEATING LAYOUT	
Project Name RUSSEL GARDENS PHASE 3 HAMILTON, ONTARIO			Date AUG/2020	Scale 3/16" = 1'-0"
LOT 19 MOUNTAINASH 5 3298 sqft			BCIN# 19669	
			LO#	87203