

CITY OF HAMILTON
Building Division

Permit No. **20-199450**

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

JAN 15 2021

8/12 roof pitch unless noted

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with
Part 9 of O.B.C. 2012 (2019 amendment).
Roof rafters that cross over or meet trusses
to be min. 2x4 SPF #2 @ 24" o/c with a
vertical post to the truss at each cross
point. Vertical posts longer than 6' to have
lateral bracing so that the distance between
the post end points and lateral bracing does
not exceed 6'.

DESIGN CONFORMS WITH OBC 2012
(2019 amendment) OCCUPANCY:
RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:


TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf


HARDWARE:

LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
LUS26-2-(VV)

BEAMS:

B20= B21 =
2 / 2x10 SPF #2

 DENOTES:
CONVENTIONAL
FRAMING

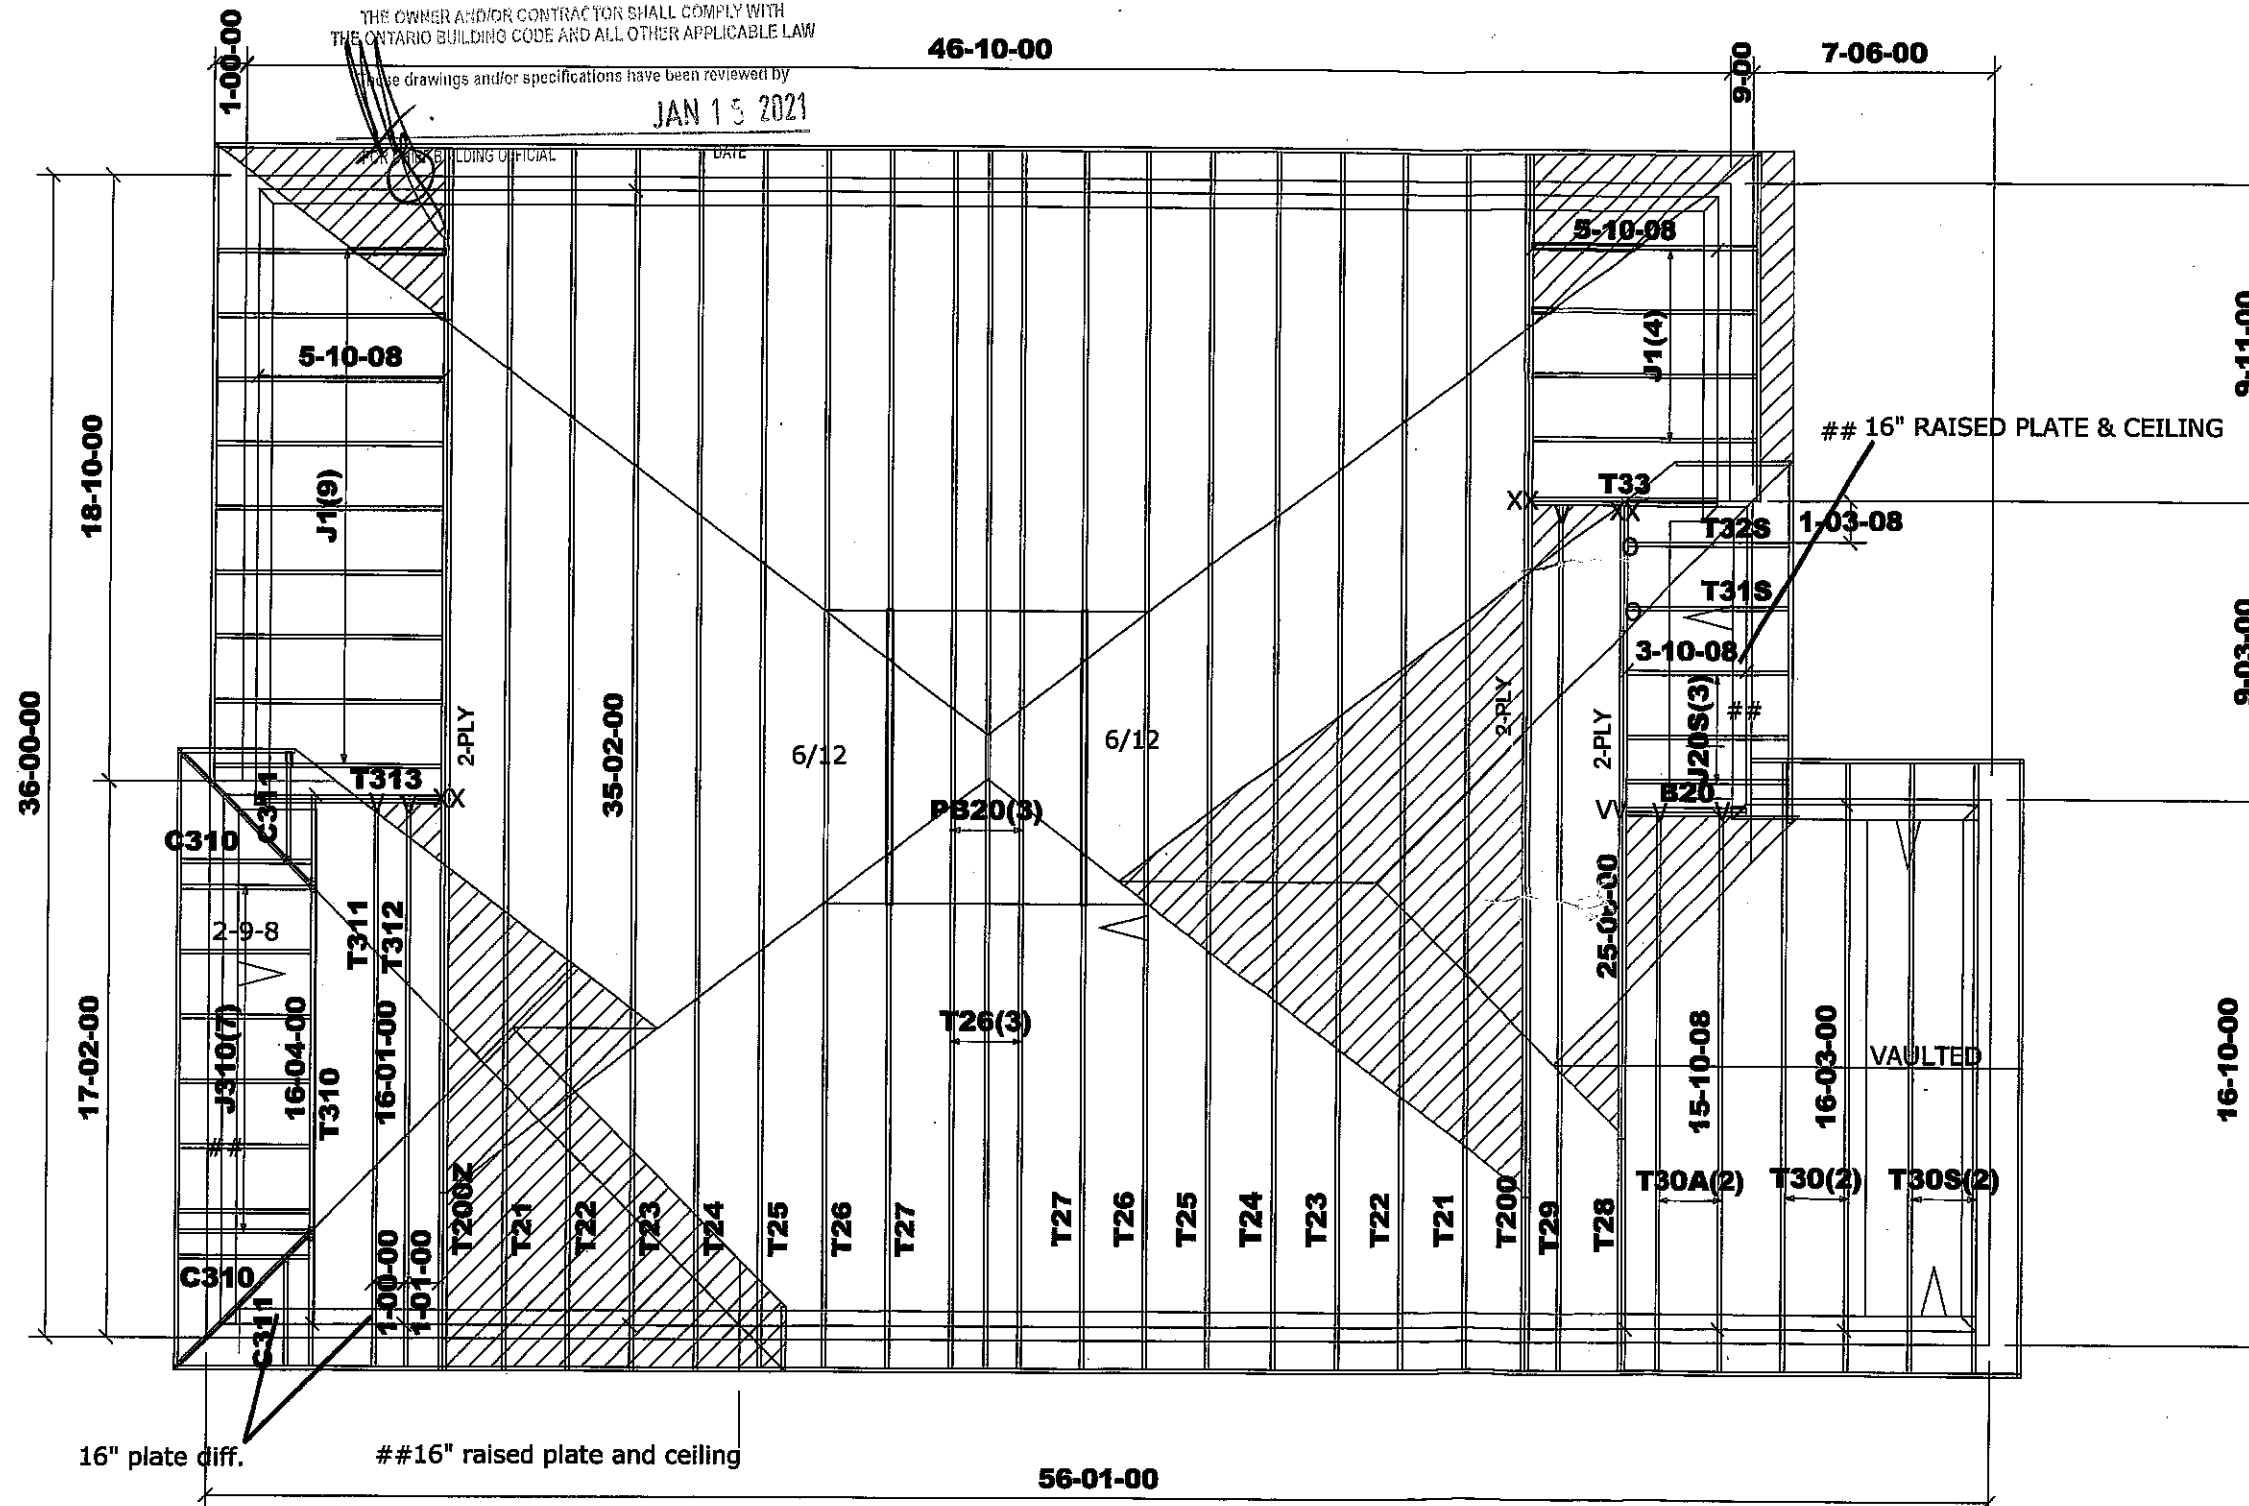

M13126



Job Track: **51225**

Plan Log: **202406**

Layout ID: **412083**

Builder / Location:

GREEN PARK HOMES / WATERDOWN

Project: **RUSSELL GARDENS PH.3**

Date: 2020-08-25

Sales: **Mario DiCano**

Designer: JG

Model / Elevation:

MOUNTAINASH 5-0132- OPT.5BRM

Mitek ver 8.3.3.247

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR
REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY
TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

DELIVERY SHIPLIST




Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 5-*c13*
 Lot #:
 Elevation: 2- OPT.5BRM

Job Track: 51225
 PlanLog: 202406
 Layout ID: 412083
 Ref #
 Page: 1 of 3
 Date: 08-25-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T21 Hip	8 / 12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	279.76 177.00		
	2	T22 Hip	8 / 12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	302.77 191.33		
	2	T23 Hip	8 / 12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	309.14 195.67		
	2	T24 Hip	8 / 12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	316.79 196.67		
	2	T25 Hip	8 / 12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	329.26 206.00		
	5	T26 Hip	8 / 12	35-02-00	10-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	857.95 538.33		
	2	T27 Hip	8 / 12	35-02-00	11-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	332.54 206.67		
	1 2-ply	T28 Hip Girder	8 / 12	25-06-00	5-03-13	2 x 4 2 x 6	1-03-08	1-04-13 2-08-13	244.99 150.00		
	1	T29 Hip	8 / 12	25-06-00	6-07-13	2 x 4	1-03-08	1-04-13 2-08-13	108.69 70.33		
	2	T30 Common	8 / 12	16-03-00	6-09-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	144.92 91.33		
	2	T30A Common	8 / 12	15-10-08	6-09-13	2 x 4	1-03-08	1-04-13 1-04-13	139.63 87.67		
	2	T30S Scissor	8 / 12 4 / 12	16-03-00	6-09-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	133.1 87.33		
	1	T31S Half Hip	8 / 12	3-10-08	4-09-13	2 x 4	1-03-08	1-04-13 4-09-13	29.4 20.17		
	1	T32S Half Hip	8 / 12	3-10-08	3-05-13	2 x 4	1-03-08	1-04-13 3-05-13	24.85 17.17		

DELIVERY SHIPLIST

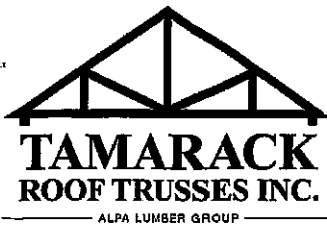

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 5-013
 Lot #:
 Elevation: 2- OPT.5BRM

Job Track: 51225
 PlanLog: 202406
 Layout ID: 412083
 Ref #
 Page: 2 of 3
 Date: 08-25-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T33 Jack-Closed Girder	6 /12	5-10-08	4-01-04	2 x 4 2 x 6		1-02-00 4-01-04	57.64 37.00		
	1 2-ply	T200 Hip Girder	8 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	357.58 220.67		
	1 2-ply	T200Z Hip Girder	8 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	357.58 220.67		
	1	T310 Hip Girder	8 /12	16-04-00	3-03-02	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	64.93 41.50		
	1	T311 Hip	8 /12	16-01-00	5-11-02	2 x 4	1-03-08	2-08-13 2-10-13	73.38 47.83		
	1	T312 Hip	8 /12	16-01-00	6-05-02	2 x 4	1-03-08 1-03-08	2-06-13 2-08-13	73.21 46.67		
	1 2-ply	T313 Flat Girder	0 /12	5-10-08	1-04-00	2 x 6		1-04-00 1-04-00	53.6 35.00		
	3	PB20 Piggyback	8 /12	9-00-12	2-00-00	2 x 4			74.54 50.50		
	13	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	218.33 138.67		
	3	J20S Jack-Open	8 /12	3-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	85.86 57.50		
	7	J310 Jack-Open	8 /12	2-09-08	3-03-02	2 x 4	1-03-08	1-04-13 3-03-02	82.84 57.17		
	2	C310 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 10-09	1-04-13 2-08-02	20.42 14.00		
	2	C311 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 1-01	1-04-13 2-08-02	18.61 12.67		


TOTAL # TRUSS= 69

TOTAL BFT OF ALL TRUSSES= 3214.52

BFT.

TOTAL WEIGHT OF ALL TRSSES 5092.09 LBS

DELIVERY SHIPLIST

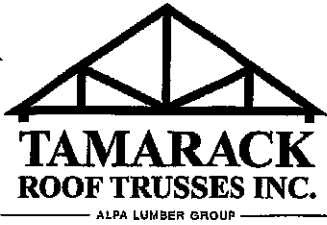

Lumber Yard: TAMARACK LUMBER
Builder: GREEN PARK HOMES
Project: RUSSELL GARDENS PH.3
Location: WATERDOWN
Model: MOUNTAINASH 5-013
Lot #:
Elevation: 2- OPT.5BRM


Job Track: 51225
PlanLog: 202406
Layout ID: 412083
Ref #
Page: 3 of 3
Date: 08-25-2020
Designer:
Sales Rep: Mario DiCano

HARDWARE


QTY	TYPE	MODEL	LENGTH
3	Hardware	HGUS26-2	
5	Hardware	LJS26DS	
2	Hardware	LUS24	
1	Hardware	LUS26-2	

TOTAL NUMBER OF ITEMS= 11

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T1	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:48 2020 Page 1					
ID:DMCubINVR6TstFoe31v6l_zns1l-Mcniq2FIKqQuZwGH_JYg9JSj_3jk34wGOWeS2NBRL					
Scale = 1:57.3					

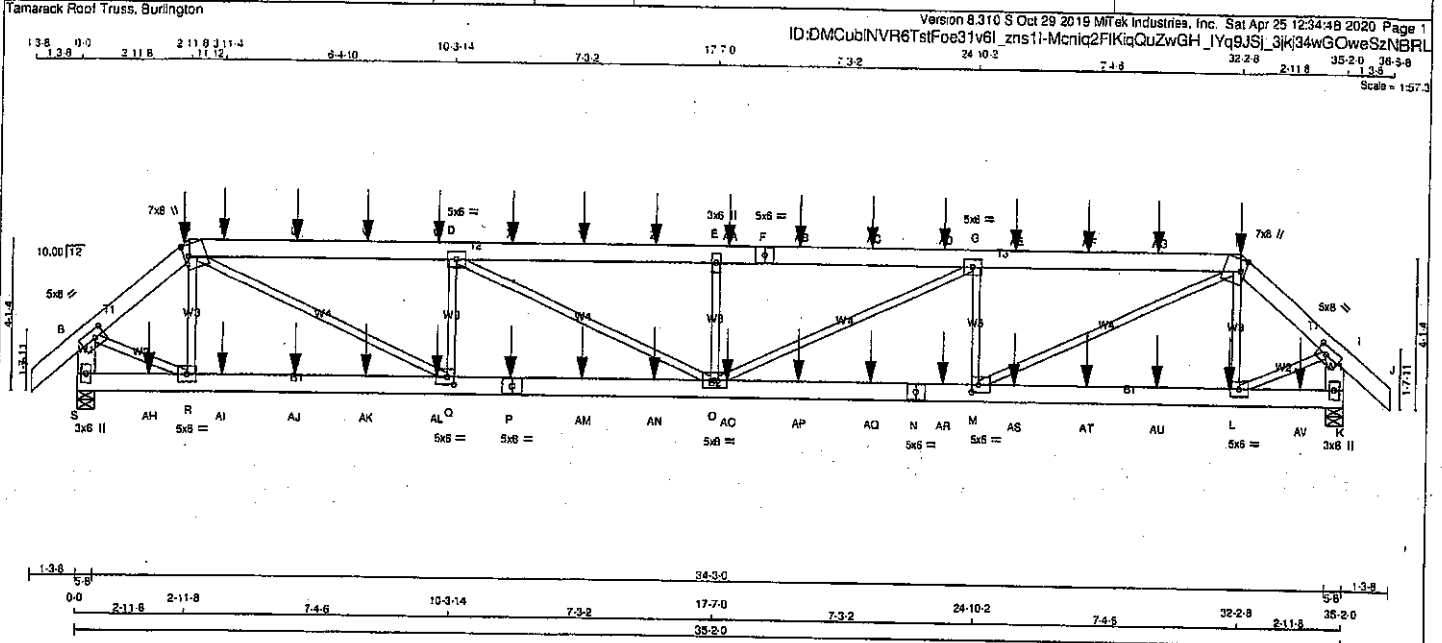

LUMBER N.L.G.A. RULES CHORDS SIZE LUMBER DESCR. A - C 2x6 DRY No.2 SPF C - F 2x6 DRY No.2 SPF F - H 2x6 DRY No.2 SPF H - J 2x6 DRY No.2 SPF S - B 2x6 DRY No.2 SPF K - I 2x6 DRY No.2 SPF P - N 2x6 DRY 2100F1.8E SPF N - K 2x6 DRY 2100F1.8E SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT		DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED GROSS REACTION MAXIMUM FACTORED GROSS REACTION INPUT RECORD JT VERT HORZ DOWN HORZ UPLIFT IN-SX BRG IN-SX S 3330 0 3330 0 0 5-8 5-8 K 3379 0 3379 0 0 5-8 5-8 UNFACTORED REACTIONS 1ST LCASE MAX/MIN COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM LIVE WIND DEAD SOIL S 2354 1553 / 0 0 / 0 0 / 0 801 / 0 0 / 0 K 2388 1572 / 0 0 / 0 0 / 0 816 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLINE SPACING = 3.98 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS FACTORED MAX. FACTORED FROM TO WEBS MAX. FACTORED FROM TO MEMB. FORCE (LBS) VERT. LOAD (PLF) CSI (LC) UNBRAC LENGTH FR-TO MEMB. FORCE (LBS) MAX. FACTORED CSI (LC) FR-TO A-B 0 / 42 -91.8 -91.8 0.04 (1) 10.00 R-C -850 / 0 0.08 (1) B-C -3397 / 0 -91.8 -91.8 0.05 (1) 8.02 C-Q 0 / 4509 0.58 (1) C-T -6802 / 0 -91.8 -91.8 0.38 (1) 4.31 Q-D -1799 / 0 0.22 (1) T-U -6802 / 0 -91.8 -91.8 0.38 (1) 4.31 D-O 0 / 1370 0.17 (1) U-V -6802 / 0 -91.8 -91.8 0.38 (1) 4.31 O-E -997 / 0 0.12 (1) V-W -6802 / 0 -91.8 -91.8 0.38 (1) 4.31 E-G 0 / 1362 0.17 (1) W-D -6802 / 0 -91.8 -91.8 0.38 (1) 4.31 G-H -1787 / 0 0.21 (1) D-X -7826 / 0 -91.8 -91.8 0.42 (1) 3.98 H-I 0 / 4481 0.58 (1) X-Y -7826 / 0 -91.8 -91.8 0.42 (1) 3.98 I-H -881 / 0 0.08 (1) Y-Z -7826 / 0 -91.8 -91.8 0.42 (1) 3.98 B-R 0 / 2736 0.34 (1) Z-E -7826 / 0 -91.8 -91.8 0.42 (1) 3.98 L-I 0 / 2771 0.34 (1) E-AA -7826 / 0 -91.8 -91.8 0.42 (1) 3.98 AA-F -7826 / 0 -91.8 -91.8 0.42 (1) 3.98 F-AB -7826 / 0 -91.8 -91.8 0.42 (1) 3.98 AB-AC -7826 / 0 -91.8 -91.8 0.42 (1) 3.98 AC-AD -7826 / 0 -91.8 -91.8 0.42 (1) 3.98 AD-G -7826 / 0 -91.8 -91.8 0.42 (1) 3.98 G-AE -6808 / 0 -91.8 -91.8 0.38 (1) 4.31 AE-AF -6808 / 0 -91.8 -91.8 0.38 (1) 4.31 AF-AG -6808 / 0 -91.8 -91.8 0.38 (1) 4.31 AG-H -6808 / 0 -91.8 -91.8 0.38 (1) 4.31 H-I -3410 / 0 -91.8 -91.8 0.05 (1) 6.00 I-J 0 / 42 -91.8 -91.8 0.04 (1) 10.00 S-B -3375 / 0 0.0 0.0 0.12 (1) 7.58 K-I -3414 / 0 0.0 0.0 0.12 (1) 7.55 S-AH 0 / 0 -18.5 -18.5 0.05 (4) 10.00 AH-R 0 / 0 -18.5 -18.5 0.05 (4) 10.00 R-AI 0 / 2553 -18.5 -18.5 0.12 (1) 10.00 AI-AJ 0 / 2553 -18.5 -18.5 0.12 (1) 10.00 AJ-AK 0 / 2553 -18.5 -18.5 0.12 (1) 10.00 AK-AL 0 / 2553 -18.5 -18.5 0.12 (1) 10.00 AL-Q 0 / 2553 -18.5 -18.5 0.12 (1) 10.00 Q-P 0 / 6602 -18.5 -18.5 0.22 (1) 10.00 P-AM 0 / 6602 -18.5 -18.5 0.22 (1) 10.00 AM-AN 0 / 6602 -18.5 -18.5 0.22 (1) 10.00 AN-O 0 / 6609 -18.5 -18.5 0.22 (1) 10.00 O-AO 0 / 6609 -18.5 -18.5 0.22 (1) 10.00 AO-AP 0 / 6609 -18.5 -18.5 0.22 (1) 10.00 AP-AQ 0 / 6609 -18.5 -18.5 0.22 (1) 10.00 AQ-N 0 / 6609 -18.5 -18.5 0.22 (1) 10.00 N-AR 0 / 6609 -18.5 -18.5 0.22 (1) 10.00 AR-M 0 / 6609 -18.5 -18.5 0.22 (1) 10.00		DESIGN CRITERIA *** SPECIAL LOADS ANALYSIS *** GEOMETRY AND/OR BASIC LOADS CHANGED BY USER. LOADS WERE DERIVED FROM USER INPUT NO FURTHER MODIFICATIONS WERE MADE SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12 *** NON STANDARD GIRDER *** ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES. THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF BCBC 2018, OBC 2012, ABC 2019 - PART 9 OF OBC 2012 (2019 AMENDMENT) - CSA 086-09, CSA 086-14 - TPIC 2011, TPIC 2014 (55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL) = L/360 (1.17) CALCULATED VERT. DEFL.(LL) = L/899 (0.20") ALLOWABLE DEFL.(TL) = L/360 (1.17) CALCULATED VERT. DEFL.(TL) = L/899 (0.37") CSI: TC=0.42/1.00 (D-E:1), BC=0.22/1.00 (D-Q:1), WB=0.56/1.00 (C-Q:1), SSI=0.22/1.00 (C-D:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00 COMPANION LIVE LOAD FACTOR = 1.00 AUTOSOLVE HEELS OFF TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (FLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 768 1667 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.89 (H) (INPUT = 0.90) JSI METAL= 0.65 (N) (INPUT = 1.00)	
---	--	--	--	---	--

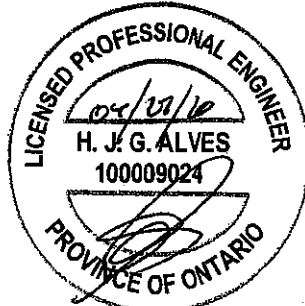

Structural component only
DWG# T-2007129 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408168	T1	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:34:48 2020 Page 2
ID:DMCubINVR6TstFoe31v6I zns1l-Monq2FikgQuZwGH IYq8JSI 3ik34wGOWeSzNBRL

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	8.0	2.50	3.25
C	TTWW-m	MT20	7.0	8.0	3.75	1.50
D	TMVW-t	MT20	5.0	8.0		
E	TMVW-w	MT20	3.0	8.0		
F	TS-t	MT20	5.0	8.0		
G	TMVW-t	MT20	5.0	8.0		
H	TTWW-m	MT20	7.0	8.0	3.75	1.50
I	TMVW-t	MT20	5.0	8.0	2.50	3.25
K	BMV1-p	MT20	3.0	6.0		
L	BMVW-t	MT20	5.0	6.0		
M	BMVW-t	MT20	5.0	6.0	2.50	2.25
N	BS-t	MT20	5.0	6.0		
O	BMVW-t	MT20	5.0	6.0		
P	BS-t	MT20	5.0	6.0		
Q	BMVW-t	MT20	5.0	6.0	2.50	2.25
R	BMVW-t	MT20	5.0	6.0		
S	BMV1-p	MT20	3.0	6.0		

LOADING

TOTAL LOAD CASES: (4)


CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS (LC)
FR-TO	FROM TO	LENGTH FR-TO	
MAS	0 / 2586	-18.5	-18.5 0.12 (1) 10.00
AS-AT	0 / 2586	-18.5	-18.5 0.12 (1) 10.00
AT-AU	0 / 2586	-18.5	-18.5 0.12 (1) 10.00
AU-L	0 / 2586	-18.5	-18.5 0.12 (1) 10.00
L-AV	0 / 0	-18.5	-18.5 0.05 (1) 10.00
AV-K	0 / 0	-18.5	-18.5 0.05 (1) 10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-11-8	-38	-42	---	FRONT	VERT	DEAD	---	C1
C	2-11-8	-191	-191	---	FRONT	VERT	SNOW	---	C1
H	32-2-8	-38	-42	---	FRONT	VERT	DEAD	---	C1
H	32-2-8	-116	-116	---	FRONT	VERT	TOTAL	---	C1
H	32-2-8	-191	-191	---	FRONT	VERT	SNOW	---	C1
L	31-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
P	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	3-11-4	-111	-111	---	FRONT	VERT	TOTAL	---	C1
U	5-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	17-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	19-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	21-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	23-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	25-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	27-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AG	29-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AH	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AL	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AM	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AN	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	17-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AP	19-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AQ	21-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AR	23-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AS	25-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AT	27-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AU	29-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AV	33-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

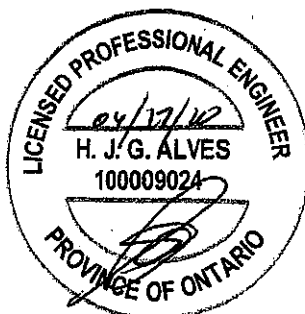


Structural component only
DWG# T-2007129

JOB NAME 408168	TRUSS NAME T1Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:49 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns11-qoL41NGw50yHWjVSripnNNrbzOlzT47D9w8UBuzNBK

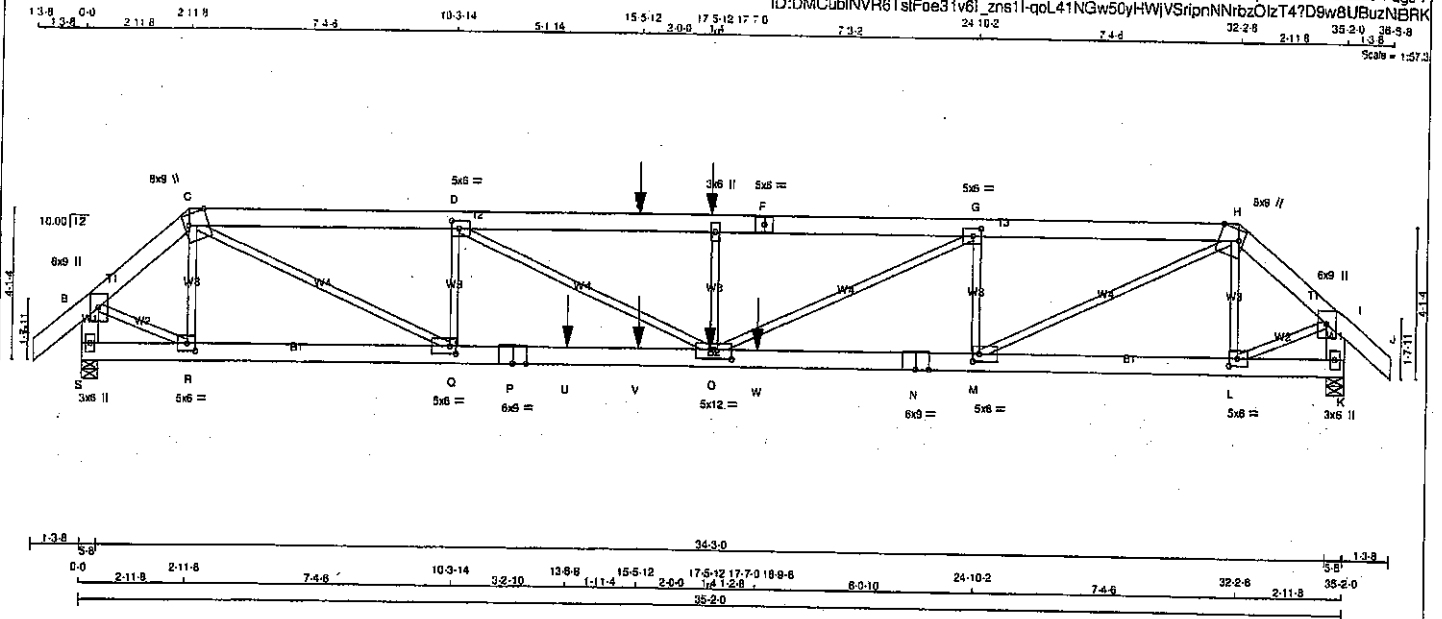

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x6	DRY No.2	SPF
C - F	2x6	DRY No.2	SPF
F - H	2x6	DRY No.2	SPF
H - J	2x6	DRY No.2	SPF
J - L	2x6	DRY No.2	SPF
L - N	2x6	DRY No.2	SPF
N - K	2x6	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	2	TOP
C-F	2	TOP
F-H	2	TOP
H-J	2	TOP
J-L	2	TOP
L-N	2	TOP
N-K	2	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S-P	2	TOP
P-N	2	TOP
N-K	2	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	TOP

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORIZ	UPLIFT	BRG	BRG	IN-SX
S	3683	0	3683	0	0	0	5-8	5-8	5-8
K	3687	0	3687	0	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS		MAX./MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE
S	2783	1890 / 0	0 / 0
K	2589	1758 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)	
CHORDS	MEMB.	MAX. FACTORED	FACTORED
FR-TO	FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
A-B	0 / 42	-91.8	10.00
B-C	-3986 / 0	-91.8	5.65
C-D	-8534 / 0	-91.8	3.74
D-E	-12331 / 0	-91.8	3.20
E-F	-12331 / 0	-91.8	3.20
F-G	-12331 / 0	-91.8	3.23
G-H	-8575 / 0	-91.8	3.94
H-I	-3758 / 0	-91.8	5.78
I-J	0 / 42	-91.8	10.00
J-K	-3945 / 0	0.0	7.14
K-L	-3733 / 0	0.0	7.29
S-R	0 / 0	-18.5	10.00
R-Q	0 / 3013	-18.5	10.00
Q-P	0 / 9534	-18.5	10.00
P-U	0 / 9534	-18.5	10.00
U-V	0 / 9534	-18.5	10.00
V-W	0 / 9534	-18.5	10.00
W-N	0 / 8575	-18.5	10.00
N-M	0 / 8575	-18.5	10.00
M-L	0 / 2844	-18.5	10.00
L-K	0 / 0	-18.5	10.00

FACTORED CONCENTRATED LOADS (LBS)	
LOC.	MAX.
JT	-110
E	-28
T	-110
U	-1615
V	-28
W	-1620

CONNECTION REQUIREMENTS
1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 183 = 366 lb

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
BOT CH. LL	= 6.0 PSF
TOTAL LOAD	= 39.0 PSF
SPACING	= 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.35')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/657 (0.64')
CSI: TC=0.52/1.00 (D-E:1), BC=0.67/1.00 (O-Q:1), WB=0.90/1.00 (C-Q:1), SS=0.53/1.00 (M-O:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00
COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES	
PLATE GRIP (DRY)	SHEAR SECTION
(PSI)	(PLI)
MT20	618 354 1687 788 1987 1688

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP = 0.89 (C) (INPUT = 0.90)
JSI METAL = 0.95 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007130

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T1Z	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:49 2020 Page 2
ID:DMCubNVR6TstFoe31vgI zns1l-gqL41NQw50yH-WVVSrpnNNrbzOizT4?D9w8UBuzNBRK

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	6.0	9.0		
C	TTWW+m	MT20	8.0	9.0	Edge 6.50	
D	TMWW-t	MT20	5.0	6.0	2.50	2.50
E	TMW+w	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMWW-l	MT20	5.0	6.0	2.50	2.50
H	TTWW-m	MT20	8.0	9.0	Edge 6.50	
I	TMVW+p	MT20	6.0	9.0		
K	BMV1+p	MT20	3.0	6.0		
L	BMWW-t	MT20	5.0	6.0	2.50	2.75
M	BMWW-l	MT20	5.0	8.0	2.50	2.00
N	BS-t	MT20	6.0	9.0		
O	BMWWW-t	MT20	5.0	12.0	3.00	6.00
P	BS-t	MT20	6.0	9.0		
Q	BMWW-l	MT20	5.0	8.0	2.50	2.00
R	BMWW-t	MT20	5.0	6.0	2.50	2.75
S	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.




Structural component only
DWG# T-2007130 92

JOB NAME 408168	TRUSS NAME T2	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:50 2020 Page 1
ID:DMCubINVR6TstFoe31v6f_zns11-7vSFHZs487s3IPPK0vaOkacIOcfaMOatIKzNBRJ

1.3-8 0.0 4-1-14 5-5-3 9-7-1 5-3-15 14-11-0 5-3-15 20-3-0 5-3-15 25-5-15 5-5-3 31-0-2 4-1-14 35-2-0 35-5-8 1.3-8
Scale = 1:57.3

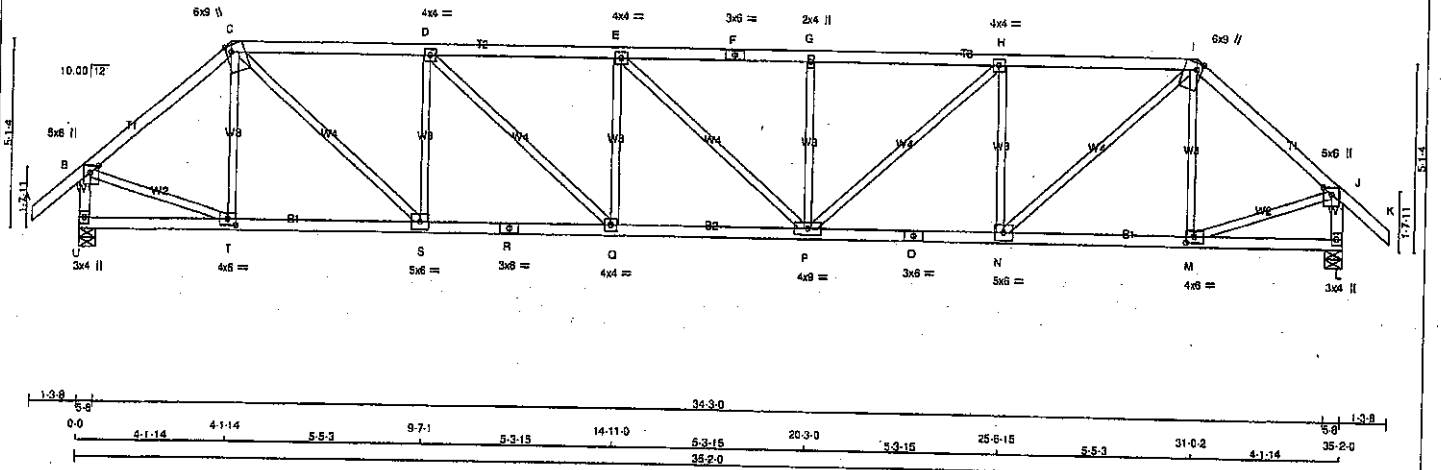

LUMBER

N. L. G. A. RULES

CHORDS SIZE LUMBER DESCR

A - C 2x4 DRY No.2 SPF

C - F 2x4 DRY No.2 SPF

F - I 2x4 DRY No.2 SPF

I - K 2x4 DRY No.2 SPF

L - B 2x4 DRY No.2 SPF

L - J 2x4 DRY No.2 SPF

U - R 2x4 DRY No.2 SPF

R - O 2x4 DRY No.2 SPF

O - L 2x4 DRY No.2 SPF

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT

DRY: SEASONED LUMBER.

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION	GROSS REACTION	DOWN	HORIZ	BRG	BRG	IN-SX	IN-SX
JT VERT	2066	0	0	0	0	5-8	5-8
U	2066	0	0	0	0	5-8	5-8
L	2066	0	0	0	0	5-8	5-8

UNFACTORED REACTIONS		MAX/MIN COMPONENT REACTIONS		DEAD		SOIL	
1ST LOASE	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
U	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.20 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

TS-I

MT20

3.0

6.0

TMW+rw

MT20

2.0

4.0

TTWW+m

MT20

6.0

9.0

TMVW+p

MT20

5.0

8.0

BMV1+p

MT20

3.0

4.0

BMWV+I

MT20

4.0

5.0

BMWV+I

MT20

5.0

6.0

BS-I

MT20

3.0

6.0

BMWVW+I

MT20

4.0

9.0

BMWV+I

MT20

4.0

4.0

BS-I

MT20

3.0

6.0

BMWVW+I

MT20

5.0

8.0

BMWV+I

MT20

4.0

8.0

BMV1+p

MT20

3.0

4.0

Edge - INDICATES REFERENCE CORNER OF PLATE

OUCHES EDGE OF CHORD.

CHORDS

MAX. FACTORED

FACTORED

MEMB.

FORCE

VERT. LOAD

LC1

MAX

MAX.

UNBRAC

MEMB.

MAX.

FACTORED

FORCE

MAX

(LBS)

(PLF)

CSI (LC)

LENGTH

FR-TO

(LBS)

CSI (LC)

FR-TO

FROM

TO

FR-TO

A-B

0 / 41

-91.8

-91.8

0.13 (1)

10.00

T-C

-358 / 0

0.14 (1)

B-C

-1980 / 0

-91.8

-91.8

0.38 (1)

4.46

C-S

0 / 1836

0.41 (1)

C-D

-2871 / 0

-91.8

-91.8

0.57 (1)

3.59

S-D

-1118 / 0

0.43 (1)

D-E

-3506 / 0

-91.8

-91.8

0.85 (1)

3.21

D-Q

0 / 856

0.19 (1)

E-F

-3505 / 0

-91.8

-91.8

0.53 (1)

3.38

Q-E

-475 / 0

0.18 (1)

F-G

-3505 / 0

-91.8

-91.8

0.53 (1)

3.36

E-P

-2 / 0

0.00 (1)

G-H

-3505 / 0

-91.8

-91.8

0.85 (1)

3.20

P-G

-474 / 0

0.18 (1)

H-I

-2871 / 0

-91.8

-91.8

0.57 (1)

3.59

P-H

0 / 853

0.19 (1)

I-J

-1980 / 0

-91.8

-91.8

0.38 (1)

4.45

N-H

-1117 / 0

0.43 (1)

J-K

0 / 41

-91.8

-91.8

0.13 (1)

10.00

N-I

0 / 1837

0.41 (1)

U-B

-2037 / 0

0.0

0.0

0.22 (1)

5.92

M-I

-358 / 0

0.14 (1)

L-J

-2037 / 0

0.0

0.0

0.22 (1)

5.92

B-T

0 / 1571

0.35 (1)

M-J

0 / 1571

0.35 (1)

U-T

0 / 0

-18.5

-18.5

0.10 (4)

10.00

T-S

0 / 1494

-18.5

-18.5

0.30 (1)

10.00

S-R

0 / 2871

-18.5

-18.5

0.51 (1)

10.00

R-Q

0 / 2871

-18.5

-18.5

0.51 (1)

10.00

Q-P

0 / 3506

-18.5

-18.5

0.82 (1)

10.00

P-O

0 / 2872

-18.5

-18.5

0.51 (1)

10.00

O-N

0 / 2872

-18.5

-18.5

0.51 (1)

10.00

N-M

0 / 1494

-18.5

-18.5

0.30 (1)

10.00

M-L

0 / 0

-18.5

-18.5

0.10 (4)

10.00

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.17")

CALCULATED VERT. DEFL.(LL) = 1/ 999 (0.20")

ALLOWABLE DEFL.(TL)= L/360 (1.17")

CALCULATED VERT. DEFL.(TL) = 1/ 999 (0.39")

CSI: TC=0.86/1.00 (G+H:1), BC=0.62/1.00 (P-C:1), WB=0.43/1.00 (D-S:1), SSI=0.23/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1867 788 1987 1656

PROFESSIONAL ENGINEER

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")

CALCULATED VERT. DEFL.(LL) = L/999 (0.20")

ALLOWABLE DEFL.(TL) = L/360 (1.17")

CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CSI: TO=0.66/1.00 (G-H:1), BC=0.62/1.00 (P-Q:1), WB=0.43/1.00 (D-S:1), SSI=0.23/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.90 (N) (INPUT = 0.90)

JSI METAL = 0.90 (O) (INPUT = 1.00)

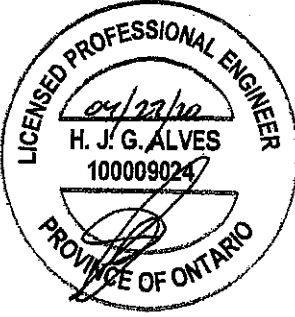

Structural component only
DWG# T-2007131

JOB NAME 408168	TRUSS NAME T3	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:34:51 2020 Page 1	
ID:DMCubINVR6TstFoe31v6l_zns1-mBTrS3I8ddC7l0ery7rFSoxJC1Ex4wWcEdaFnzNBRI				23 7 12 420 28 9 11 35 2 0 36 5 8	
Scale = 1:57.4					

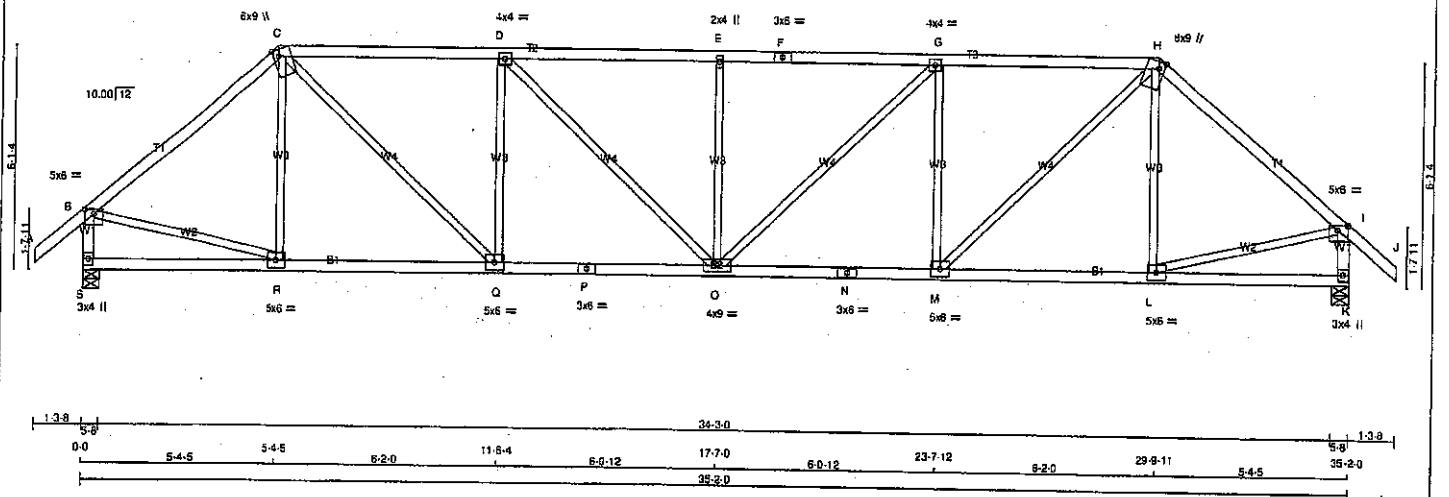

LUMBER			
N.L.G.A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
S - P	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
SPF			
DRY; SEASONED LUMBER.			

PLATES (tablets in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMVW-p	MT20	5.0	6.0	1.50 3.00
C TTWW-m	MT20	6.0	9.0	Edge 1.75
D TMVW-t	MT20	4.0	4.0	
E TMVW-w	MT20	2.0	4.0	
F TS-t	MT20	3.0	6.0	
G TMVW-t	MT20	4.0	4.0	
H TTWW-m	MT20	6.0	9.0	Edge 1.75
I TMVW-p	MT20	5.0	6.0	1.50 3.00
K BMV1+p	MT20	3.0	4.0	
L, M, O, R				
N BMVW-t	MT20	5.0	6.0	
O BS-t	MT20	3.0	6.0	
P BMVW-w	MT20	4.0	9.0	
O BS-t	MT20	3.0	6.0	
S BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
<u>BEARINGS</u>							
	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
S	2066	0	2066	0	0	5-8	5-8
K	2066	0	2066	0	0	5-8	5-8
<u>UNFACTORED REACTIONS</u>							
	1ST LCASE COMBINED	MAX. MIN. COMPONENT REACTIONS					
JT		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	1458	971 / 0	0 / 0	0 / 0	0 / 0	489 / 0	0 / 0
K	1458	971 / 0	0 / 0	0 / 0	0 / 0	489 / 0	0 / 0
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K							
<u>BRACING</u>							
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.28 FT.							
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.							

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS									
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH		
FR-TO	FROM	TO	CS1 (LC)	CS1 (LC)	FR-TO	FROM	TO	CS1 (LC)	CS1 (LC)
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	R-C	-246 / 7	0.14 (1)	
B-C	-2034 / 0	-91.8	-91.8	0.84 (1)	4.11	C-Q	0 / 1538	0.35 (1)	
C-D	-2853 / 0	-91.8	-91.8	0.74 (1)	3.50	Q-D	-943 / 0	0.55 (1)	
D-E	-2978 / 0	-91.8	-91.8	0.78 (1)	3.28	D-O	0 / 450	0.10 (1)	
E-F	-2978 / 0	-91.8	-91.8	0.78 (1)	3.28	O-E	-513 / 0	0.30 (1)	
F-G	-2978 / 0	-91.8	-91.8	0.78 (1)	3.28	O-G	0 / 450	0.10 (1)	
G-H	-2853 / 0	-91.8	-91.8	0.74 (1)	4.11	M-H	-943 / 0	0.55 (1)	
H-I	-2034 / 0	-91.8	-91.8	0.84 (1)	10.00	L-H	0 / 1538	0.35 (1)	
I-J	0 / 41	0.0	0.0	0.22 (1)	5.94	B-R	-246 / 7	0.14 (1)	
S-B	-2026 / 0	0.0	0.0	0.22 (1)	5.94	R-L	0 / 1580	0.36 (1)	
K-I	-2026 / 0	0.0	0.0	0.22 (1)	5.94	L-I	0 / 1580	0.36 (1)	
S-R	0 / 0	-18.5	-18.5	0.14 (4)	10.00				
R-Q	0 / 1532	-18.5	-18.5	0.33 (1)	10.00				
Q-P	0 / 2653	-18.5	-18.5	0.49 (1)	10.00				
P-O	0 / 2653	-18.5	-18.5	0.49 (1)	10.00				
O-N	0 / 2653	-18.5	-18.5	0.49 (1)	10.00				
N-M	0 / 2653	-18.5	-18.5	0.49 (1)	10.00				
M-L	0 / 1532	-18.5	-18.5	0.33 (1)	10.00				
L-K	0 / 0	-18.5	-18.5	0.14 (4)	10.00				

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF
SPACING	= 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 055-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.17")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.16")
ALLOWABLE DEFL.(TL) = $L/360$ (1.17")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.29")
CS1: TC=0.78/1.00 (E-G:1), BC=0.49/1.00 (M-O:1), WB=0.55/1.00 (G-M:1), SS1=0.27/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.85 (N) (INPUT = 1.00)

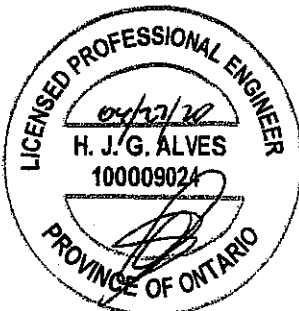

Structural component only
DWG# T-2007132


JOB NAME: 408168 TRUSS NAME: T4 QUANTITY: 2 PLY: 1 JOB DESC: GREEN PARK HOMES TRUSS DESC: Tamarack Roof Truss, Burlington DRWG NO. 1

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:52 2020 Page 1

ID:DMCubINVR6TstFos31v6l zns1i-EN1DIPpOxKsNAD1WqNU_?T6RoNZgQVnuM8oDzNBRH

1-3-8 0-0 3-4-10 3-4-10 3-2-2 8-6-11 5-5-12 12-1-8 5-5-8 17-7-0 5-5-8 23-0-8 5-5-12 28-7-5 3-2-2 31-9-8 3-4-10 39-2-0 38-3-8

Scale = 1/8" = 1'-0"

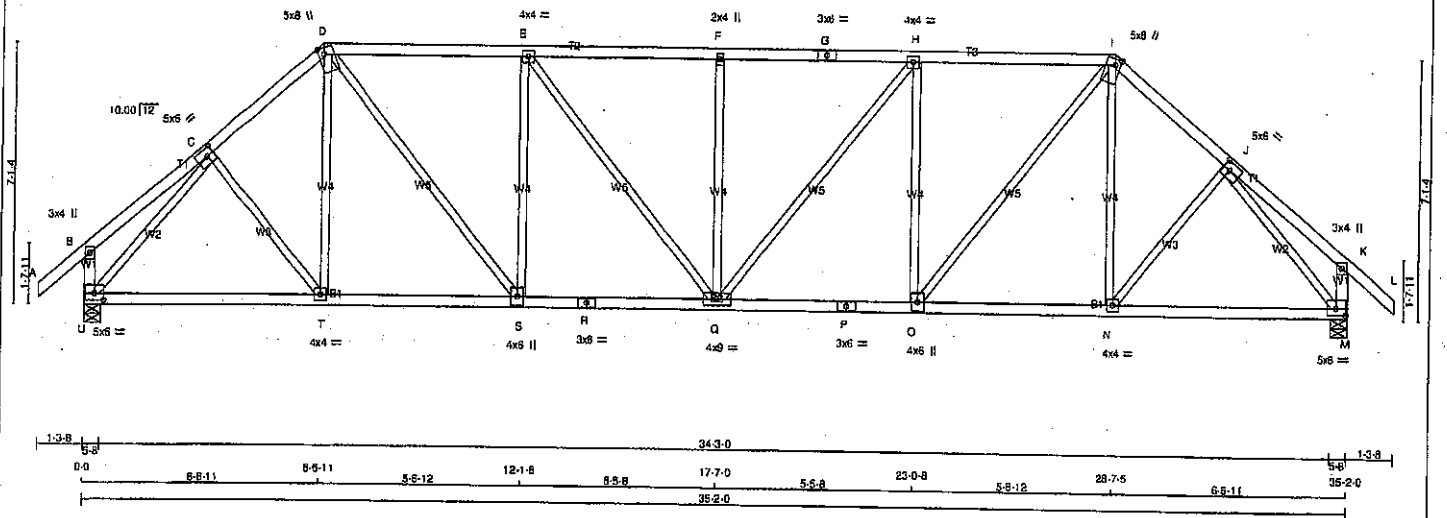

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
L - N	2x4	DRY	No.2
N - R	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+P	MT20	3.0	4.0		
C	TMVW+I	MT20	5.0	8.0	2.50	2.25
D	TTWV+m	MT20	5.0	8.0	2.00	1.75
E	TMVW+I	MT20	4.0	4.0		
F	TMVW+w	MT20	2.0	4.0		
G	TS+I	MT20	3.0	6.0		
H	TMVW+I	MT20	4.0	4.0		
I	TTWV+m	MT20	5.0	8.0	2.00	1.75
J	TMVW+I	MT20	5.0	8.0	2.50	2.25
K	TMV+P	MT20	3.0	4.0		
L	BMVW+I	MT20	5.0	8.0	2.25	3.00
M	BMVW+I	MT20	4.0	4.0		
O	BMVW+I	MT20	4.0	8.0		
P	BS+I	MT20	3.0	6.0		
Q	BMVW+I	MT20	4.0	8.0		
R	BS+I	MT20	3.0	6.0		
S	BMVW+I	MT20	4.0	8.0		
T	BMVW+I	MT20	4.0	4.0		
U	BMVW+I	MT20	5.0	8.0	2.25	3.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
U	2066 0	2066 0	0 0	5-8 5-8
M	2066 0	2066 0	0 0	5-8 5-8

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN. COMPONENT REACTIONS	SOIL
U	1458 971 / 0	0 / 0	0 / 0
M	1458 971 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8 -91.8	0.13 (1)	C-T	0 / 156	0.04 (1)	
B-C	0 / 19	-91.8 -91.8	0.14 (1)	D-T	0 / 76	0.03 (4)	
C-D	-2023 / 0	-91.8 -91.8	0.20 (1)	E-S	0 / 1220	0.27 (1)	
D-E	-2308 / 0	-91.8 -91.8	0.55 (1)	S-E	-850 / 0	0.74 (1)	
E-F	-2534 / 0	-91.8 -91.8	0.57 (1)	F-Q	0 / 361	0.08 (1)	
F-G	-2534 / 0	-91.8 -91.8	0.57 (1)	Q-H	-461 / 0	0.40 (1)	
G-H	-2534 / 0	-91.8 -91.8	0.57 (1)	H-F	0 / 361	0.08 (1)	
H-I	-2308 / 0	-91.8 -91.8	0.55 (1)	C-H	-850 / 0	0.74 (1)	
I-J	-2023 / 0	-91.8 -91.8	0.20 (1)	O-I	0 / 1220	0.27 (1)	
J-K	0 / 19	-91.8 -91.8	0.14 (1)	N-I	0 / 76	0.03 (4)	
K-L	0 / 41	-91.8 -91.8	0.13 (1)	U-M	0 / 156	0.04 (1)	
U-B	-246 / 0	0.0 0.0	0.03 (1)	J-M	-2277 / 0	0.98 (1)	
M-K	-246 / 0	0.0 0.0	0.03 (1)	U-C	-2277 / 0	0.98 (1)	
U-T	0 / 1433	-18.5 -18.5	0.33 (1)				
T-S	0 / 1535	-18.5 -18.5	0.35 (1)				
S-R	0 / 2308	-18.5 -18.5	0.42 (1)				
R-Q	0 / 2308	-18.5 -18.5	0.42 (1)				
Q-P	0 / 2308	-18.5 -18.5	0.42 (1)				
P-O	0 / 2308	-18.5 -18.5	0.42 (1)				
O-N	0 / 1535	-18.5 -18.5	0.35 (1)				
N-M	0 / 1433	-18.5 -18.5	0.33 (1)				

TOTAL WEIGHT = 2 X 162 = 323 LB

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 888-09, CSA 888-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.13")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.23")
CSI: TC=0.57/1.00 (E-F:1), BC=0.42/1.00 (O-Q:1), WB=0.98/1.00 (J-M:1), SS=0.24/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1686

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (I) (INPUT = 0.89)
JSI METAL = 0.72 (P) (INPUT = 1.00)

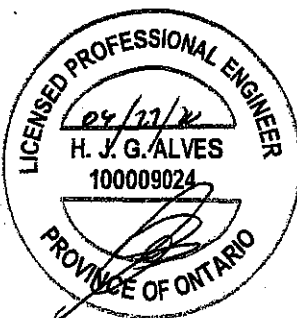

Structural component only
DWG# T-2007133

TOTAL WEIGHT = 2 X 163 = 326 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 8.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.0/12

THIS TRUSS IS SPECIFIED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC2010, CBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC2018 , CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD.

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.81 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.
1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN
THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8 -91.8 0.13 (1)	10.00	C-R	0 / 84	0.02 (4)	
B-C	0 / 26	-91.8 -91.8 0.21 (1)	10.00	R-D	0 / 126	0.04 (4)	
C-D	-2006 / 0	-91.8 -91.8 0.29 (1)	4.50	D-P	0 / 998	0.22 (1)	
D-E	-2169 / 0	-91.8 -91.8 0.73 (1)	3.81	P-E	-660 / 0	0.02 (1)	
E-F	-2162 / 0	-91.8 -91.8 0.73 (1)	3.81	E-O	-2 / 0	0.80 (1)	
F-G	-2162 / 0	-91.8 -91.8 0.73 (1)	3.81	O-G	-649 / 0	0.82 (1)	
G-H	-2162 / 0	-91.8 -91.8 0.73 (1)	3.81	H-I	0 / 996	0.22 (1)	
H-I	-2006 / 0	-91.8 -91.8 0.29 (1)	4.50	I-H	0 / 126	0.04 (4)	
J-K	0 / 26	-91.8 -91.8 0.21 (1)	10.00	M-I	0 / 84	0.02 (4)	
K-L	0 / 41	-91.8 -91.8 0.13 (1)	10.00	S-C	-2291 / 0	0.97 (1)	
S-B	-254 / 0	0.0 0.0 0.03 (1)	7.81	F-L	-2291 / 0	0.97 (1)	
L-J	-284 / 0	0.0 0.0 0.03 (1)	7.81				
S-R	0 / 1467	-18.5 -18.5 0.38 (1)	10.00				
R-Q	0 / 1519	-18.5 -18.5 0.39 (1)	10.00				
Q-P	0 / 1519	-18.5 -18.5 0.39 (1)	10.00				
P-O	0 / 2163	-18.5 -18.5 0.42 (1)	10.00				
O-N	0 / 1519	-18.5 -18.5 0.39 (1)	10.00				
N-M	0 / 1519	-18.5 -18.5 0.39 (1)	10.00				
M-L	0 / 1467	-18.5 -18.5 0.38 (1)	10.00				




Structural component only
DWG# T-2007134

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T6	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtl Industries, Inc. Sat Apr 25 12:34:55 2020 Page 1

ID:DMCubiNVR6TstFoe31v61_zns1-l-eylRLhslQEaycBzwBce5fPpQxtx5XsboOYzNBRE

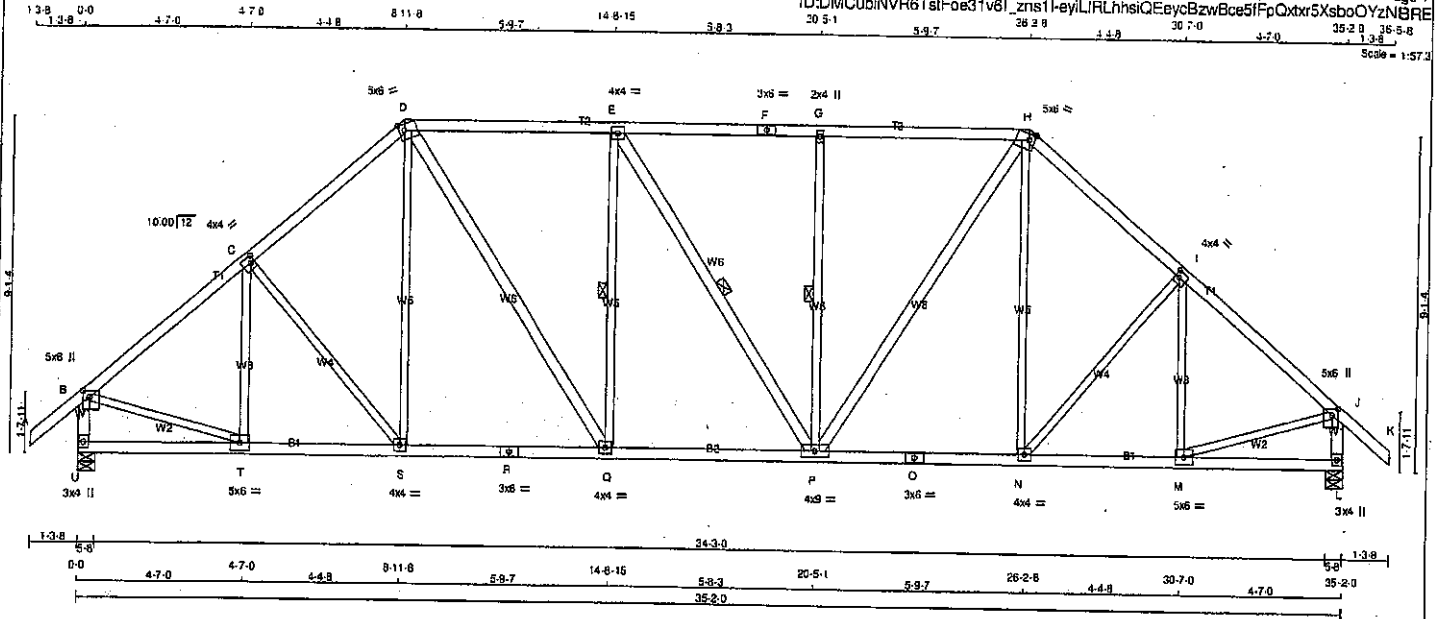

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2

ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - Q	2x4	DRY	No.2
E - P	2x4	DRY	No.2
P - H	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (Tables in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	2.00	2.00
C	TMVW-t	MT20	4.0	4.0	2.00	1.25
D	TTVW-m	MT20	5.0	6.0	2.00	1.75
E	TMVW-t	MT20	4.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMVW-w	MT20	2.0	4.0		
H	TTVW-m	MT20	5.0	6.0	2.00	1.75
I	TMVW-t	MT20	4.0	4.0	2.00	1.25
J	TMVW-p	MT20	5.0	6.0	2.00	2.00
L	BMV1-p	MT20	3.0	4.0		
M	BMVW-t	MT20	5.0	6.0		
N, Q, S						
N	BMVW-t	MT20	4.0	4.0		
O	BS-t	MT20	3.0	6.0		
P	BMVW-t	MT20	4.0	4.0		
R	BS-t	MT20	3.0	6.0		
T	BMVW-t	MT20	5.0	6.0		
U	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORIZ	UPLIFT
U	2066	0	0	5-8
L	2066	0	0	5-8

UNFACTORED REACTIONS

	1ST LCASE	MAX./MIN.	COMPONENT REACTIONS
	COMBINED	SNOW	LIVE
U	1458	971 / 0	0 / 0
L	1458	971 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.44 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, E-P, G-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	FORCE	VERT. LOAD	LC1	MAX.	CS1 (LC)	UNBRAC	MEMB.	MAX. FACTORED	FORCE	MAX.	CS1 (LC)
			(LBS)	(PLF)							(LBS)		
FR-TQ				FROM	TO			LENGTH	FR-TQ				
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	T-C	-357 / 0	0.16 (1)					
B-C	-1994 / 0	-91.8	-91.8	0.30 (1)	4.53	C-S	-121 / 0	0.10 (1)					
C-D	-1957 / 0	-91.8	-91.8	0.29 (1)	4.57	S-D	0 / 189	0.05 (4)					
D-E	-1923 / 0	-91.8	-91.8	0.40 (1)	4.44	D-Q	0 / 810	0.13 (1)					
E-F	-1921 / 0	-91.8	-91.8	0.37 (1)	4.49	Q-E	-569 / 0	0.31 (1)					
F-G	-1921 / 0	-91.8	-91.8	0.37 (1)	4.49	E-P	-3 / 0	0.00 (1)					
G-H	-1921 / 0	-91.8	-91.8	0.40 (1)	4.45	P-H	-569 / 0	0.31 (1)					
H-I	-1957 / 0	-91.8	-91.8	0.29 (1)	4.57	H-I	0 / 807	0.13 (1)					
I-J	-1994 / 0	-91.8	-91.8	0.30 (1)	4.53	N-H	0 / 189	0.05 (4)					
J-K	0 / 41	-91.8	-91.8	0.13 (1)	10.00	N-I	-121 / 0	0.10 (1)					
U-B	-2028 / 0	0.0	0.0	0.22 (1)	5.94	M-I	-358 / 0	0.16 (1)					
L-J	-2028 / 0	0.0	0.0	0.22 (1)	5.94	B-T	0 / 1817	0.38 (1)					
U-T	0 / 0	-18.5	-18.5	0.08 (4)	10.00	M-J	0 / 1617	0.38 (1)					
T-S	0 / 1555	-18.5	-18.5	0.30 (1)	10.00								
S-R	0 / 1477	-18.5	-18.5	0.30 (1)	10.00								
R-Q	0 / 1477	-18.5	-18.5	0.30 (1)	10.00								
Q-P	0 / 1923	-18.5	-18.5	0.38 (1)	10.00								
P-O	0 / 1478	-18.5	-18.5	0.30 (1)	10.00								
O-N	0 / 1478	-18.5	-18.5	0.30 (1)	10.00								
N-M	0 / 1555	-18.5	-18.5	0.31 (1)	10.00								
M-L	0 / 0	-18.5	-18.5	0.08 (4)	10.00								

TOTAL WEIGHT = 2 X 182 = 363 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2017, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/859 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/899 (0.16")

CS1: TC=0.40/1.00 (D-E:1), BC=0.39/1.00 (P-Q:1), WB=0.38/1.00 (B-T:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (S) (INPUT = 0.90)
JSI METAL= 0.50 (O) (INPUT = 1.00)



Structural component only
DWG# T-2007135

JOB NAME 408168	TRUSS NAME T7	QUANTITY 5	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:56 2020 Page 1	
ID:DMCubINVR6TsIFoe31v6f_zns11-79GkVnMJS9qHnXolqRQ9relkDmacKfMwKlX_zNBRD				35 2.0 35.5.8	

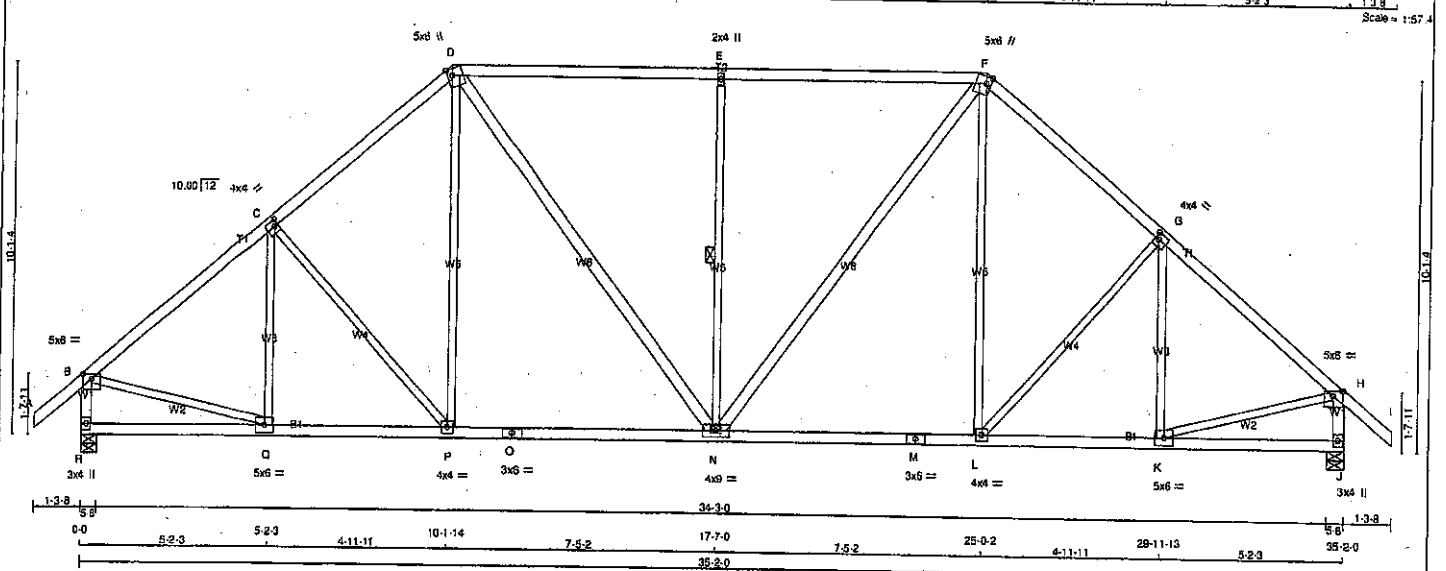

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
R - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
R - O	2x4	DRY	No.2	SPF
O - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
D - N	2x4	DRY	No.2	SPF
N - F	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (tab/a is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	5.0	1.50	3.00
C	TMVW-t	MT20	4.0	4.0	2.00	1.25
D	TTVW-m	MT20	5.0	6.0	2.25	1.50
E	TMVW-w	MT20	2.0	4.0		
F	TTVW-m	MT20	5.0	6.0	2.25	1.50
G	TMVW-t	MT20	4.0	4.0	2.00	1.25
H	TMVW-p	MT20	5.0	6.0	1.50	3.00
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-t	MT20	5.0	6.0		
L	BMVW-t	MT20	4.0	4.0		
M	BS-t	MT20	3.0	6.0		
N	BMVW-w	MT20	4.0	9.0		
O	BS-t	MT20	3.0	6.0		
P	BMVW-t	MT20	4.0	4.0		
Q	BMVW-t	MT20	5.0	6.0		
R	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
R	2066	0	2066	0	5-8	5-8
J	2066	0	2066	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
R	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
J	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.96 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX. CSI (LC)	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO			FROM TO				FR-TO		
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	Q-C	-302 / 0	0.17 (1)	
B-C	-2021 / 0	-91.8	-91.8	0.39 (1)	4.41	C-P	-217 / 0	0.25 (1)	
C-D	-1908 / 0	-91.8	-91.8	0.37 (1)	4.52	P-D	0 / 278	0.08 (1)	
D-E	-1809 / 0	-91.8	-91.8	0.74 (1)	3.98	D-N	0 / 615	0.10 (1)	
E-F	-1809 / 0	-91.8	-91.8	0.74 (1)	3.98	N-F	-538 / 0	0.58 (1)	
F-G	-1908 / 0	-91.8	-91.8	0.37 (1)	4.52	N-F	0 / 615	0.10 (1)	
G-H	-2021 / 0	-91.8	-91.8	0.39 (1)	4.41	L-F	0 / 278	0.05 (1)	
H-I	0 / 41	-91.8	-91.8	0.13 (1)	10.00	L-G	-217 / 0	0.25 (1)	
R-B	-2024 / 0	0.0	0.0	0.22 (1)	5.94	K-G	-302 / 0	0.17 (1)	
J-H	-2024 / 0	0.0	0.0	0.22 (1)	5.94	B-Q	0 / 1629	0.37 (1)	
R-Q						K-H	0 / 1629	0.37 (1)	
Q-P	0 / 0	-18.5	-18.5	0.10 (4)	10.00				
P-O	0 / 1580	-18.5	-18.5	0.34 (1)	10.00				
O-N	0 / 1437	-18.5	-18.5	0.35 (1)	10.00				
N-M	0 / 1437	-18.5	-18.5	0.35 (1)	10.00				
M-L	0 / 1437	-18.5	-18.5	0.35 (1)	10.00				
L-K	0 / 1580	-18.5	-18.5	0.34 (1)	10.00				
K-J	0 / 0	-18.5	-18.5	0.10 (4)	10.00				

TOTAL WEIGHT = 5 X 173 = 867 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 085-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/998 (0.08')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/998 (0.17')

CSK: TC=0.74/1.00 (D-E:1), BC=0.35/1.00 (L-N:1), WB=0.58/1.00 (E-N:1), SS=0.33/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1997 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (H) (INPUT = 0.90)
JSI METAL= 0.46 (O) (INPUT = 1.00)



Structural component only
DWG# T-2007136

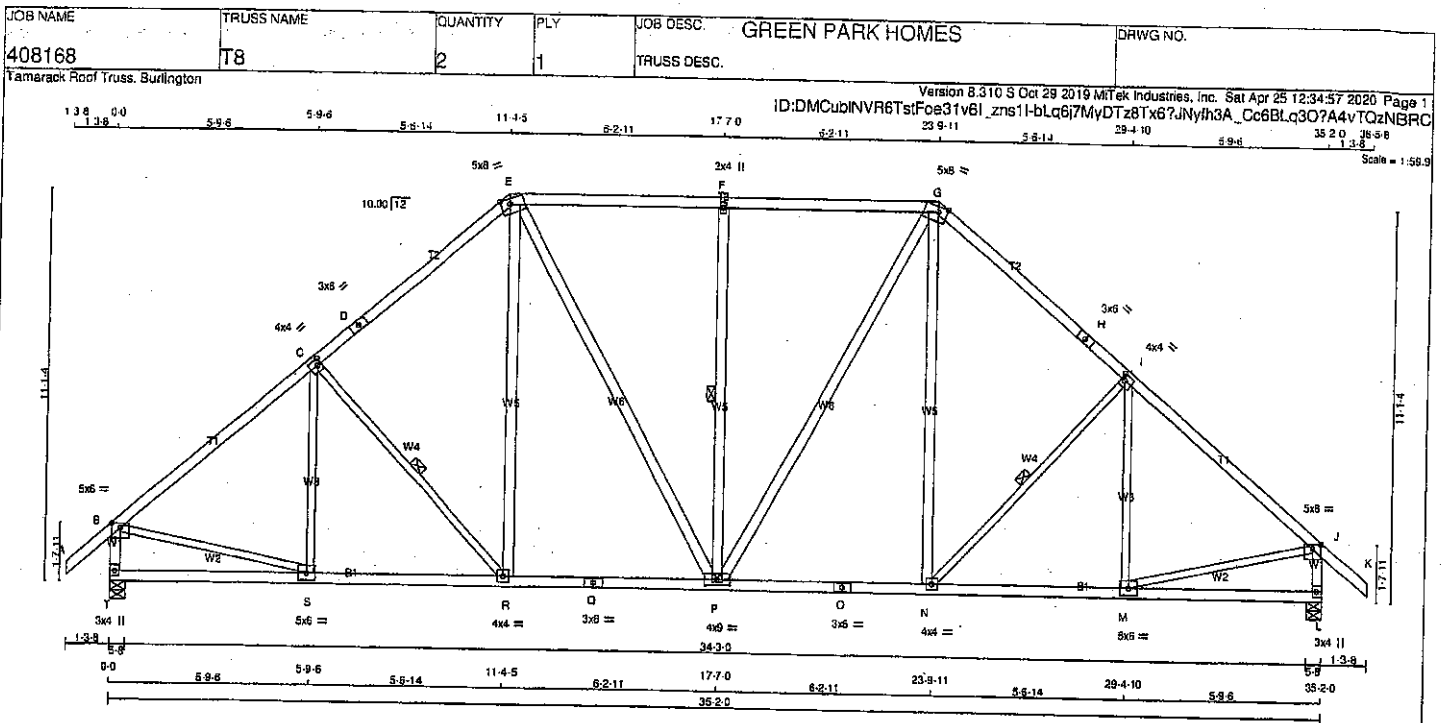

N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - G	2x4	DRY	No.2	SPF	
G - H	2x4	DRY	No.2	SPF	
H - K	2x4	DRY	No.2	SPF	
K - L	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
J - Q	2x4	DRY	No.2	SPF	
Q - O	2x4	DRY	No.2	SPF	
O - L	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x4	DRY	No.2	SPF	
S - C	2x3	DRY	No.2	SPF	
C - R	2x3	DRY	No.2	SPF	
N - I	2x3	DRY	No.2	SPF	
M - I	2x3	DRY	No.2	SPF	
B - S	2x3	DRY	No.2	SPF	
M - J	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	5.0	6.0	1.50	3.00
C	TMWW-t	MT20	4.0	4.0	2.00	1.25
O	TS-t	MT20	3.0	6.0		
E	TTWW-m	MT20	5.0	6.0	Edge	3.00
F	TMWW-w	MT20	2.0	4.0		
G	TTWW-m	MT20	5.0	6.0	Edge	3.00
H	TS-t	MT20	3.0	6.0		
I	TMWW-t	MT20	4.0	4.0	2.00	1.25
J	TMWW-p	MT20	5.0	6.0	1.50	3.00
L	BMWW-t	MT20	5.0	6.0		
N	BMWW-t	MT20	4.0	4.0		
O	BS-t	MT20	3.0	6.0		
P	BMWW-w	MT20	4.0	4.0		
Q	BS-t	MT20	3.0	6.0		
R	BMWW-t	MT20	4.0	4.0		
S	BMWW-t	MT20	5.0	6.0		
T	BMWW-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	UPLIFT	IN-SX
T	2068	0	2068	5-8
L	2068	0	2068	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
T	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.27 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-R, F-P, I-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8 -91.8	0.13 (1)	10.00	S-C	-245 / 10	0.17 (1)
B-C	-2039 / 0	-91.8 -91.8	0.50 (1)	4.27	C-R	-314 / 0	0.15 (1)
C-D	-1844 / 0	-91.8 -91.8	0.46 (1)	4.47	R-E	0 / 338	0.05 (1)
D-E	-1844 / 0	-91.8 -91.8	0.46 (1)	4.47	E-P	0 / 469	0.08 (1)
E-F	-1821 / 0	-91.8 -91.8	0.50 (1)	4.60	P-F	-699 / 0	0.45 (1)
F-G	-1821 / 0	-91.8 -91.8	0.50 (1)	4.60	P-G	0 / 469	0.08 (1)
G-H	-1844 / 0	-91.8 -91.8	0.46 (1)	4.47	N-G	0 / 338	0.05 (1)
H-I	-1844 / 0	-91.8 -91.8	0.46 (1)	4.47	N-I	-314 / 0	0.15 (1)
I-J	-2039 / 0	-91.8 -91.8	0.50 (1)	4.27	M-I	-245 / 10	0.17 (1)
J-K	0 / 41	-91.8 -91.8	0.13 (1)	10.00	B-S	0 / 1637	0.37 (1)
T-B	-2021 / 0	0.0 0.0	0.21 (1)	5.94	M-J	0 / 1637	0.37 (1)
L-J	-2021 / 0	0.0 0.0	0.21 (1)	5.94			
T-S	0 / 0	-18.5 -18.5	0.14 (4)	10.00			
S-R	0 / 1597	-18.5 -18.5	0.33 (1)	10.00			
R-Q	0 / 1387	-18.5 -18.5	0.30 (1)	10.00			
Q-P	0 / 1387	-18.5 -18.5	0.30 (1)	10.00			
P-O	0 / 1387	-18.5 -18.5	0.30 (1)	10.00			
O-N	0 / 1387	-18.5 -18.5	0.30 (1)	10.00			
N-M	0 / 1597	-18.5 -18.5	0.33 (1)	10.00			
M-L	0 / 0	-18.5 -18.5	0.14 (4)	10.00			

TOTAL WEIGHT = 2 X 180 = 360 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = U/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = U/999 (0.14")

CSI: TC=0.50/1.00 (E-F:1), BC=0.33/1.00 (M-N:1), WB=0.45/1.00 (F-P:1), SS=0.28/1.00 (E-F:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (J) (INPUT = 0.90)
JSI METAL = 0.47 (O) (INPUT = 1.00)

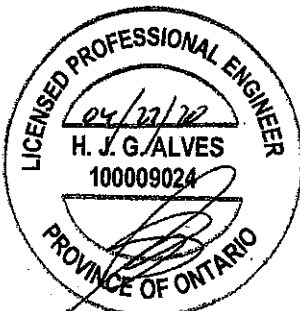


Structural component only
DWG# T-2007137

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408168	T9	6	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:34:58 2020 Page 1

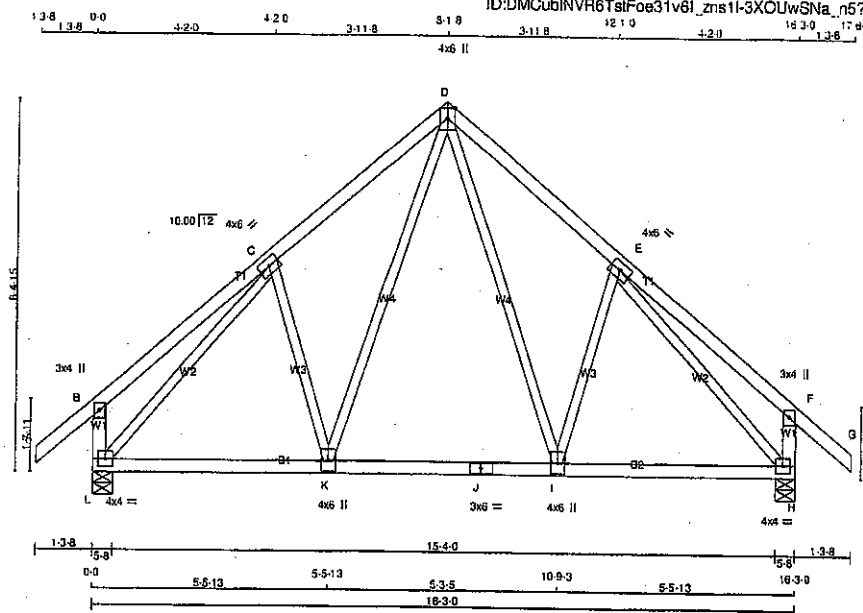

Scale: 1/4"=1'

TOTAL WEIGHT = 6 X 80 = 481 lb

(M/F)

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	8.0		
D	TTWW+p	MT20	4.0	8.0		Edge
E	TMWW-t	MT20	4.0	8.0		
F	TMV+p	MT20	3.0	4.0		
H	BMVW-t	MT20	4.0	4.0		
I	BMVW-t	MT20	4.0	8.0		
J	BS-t	MT20	3.0	8.0		
K	BMVW-t	MT20	4.0	8.0		
L	BMVW-t	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
L	1023	0	0	5-8
H	1023	0	0	5-8

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	721	487 / 0	0 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0
H	721	487 / 0	0 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 MAX (LC)
FR-TO				FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	D-I	0 / 330	0.07 (1)
B-C	0 / 28	-91.8	-91.8 0.24 (1)	10.00	I-E	-216 / 0	0.09 (1)
C-D	-745 / 0	-91.8	-91.8 0.19 (1)	6.25	K-D	0 / 330	0.07 (1)
D-E	-745 / 0	-91.8	-91.8 0.19 (1)	6.25	C-K	-216 / 0	0.09 (1)
E-F	0 / 28	-91.8	-91.8 0.24 (1)	10.00	L-C	-943 / 0	0.61 (1)
F-G	0 / 41	-91.8	-91.8 0.13 (1)	10.00	E-H	-943 / 0	0.61 (1)
L-B	-267 / 0	0.0	0.0 0.03 (1)	7.81			
H-F	-267 / 0	0.0	0.0 0.03 (1)	7.81			
L-K	0 / 616	-18.5	-18.5 0.17 (4)	10.00			
K-J	0 / 449	-18.5	-18.5 0.16 (4)	10.00			
J-I	0 / 449	-18.5	-18.5 0.16 (4)	10.00			
I-H	0 / 616	-18.5	-18.5 0.17 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 8.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")

CALCULATED VERT. DEFL.(LL) = L/999 (0.02")

ALLOWABLE DEFL.(TL) = L/360 (0.54")

CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.24/1.00 (B-C:1), BC=0.17/1.00 (H-I:4),

WB=0.61/1.00 (C-L:1), SS=0.14/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR SECTION (PL)	PL
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.76 (C) (INPUT = 0.90)

JSI METAL= 0.25 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007138

JOB NAME 408168	TRUSS NAME G9	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

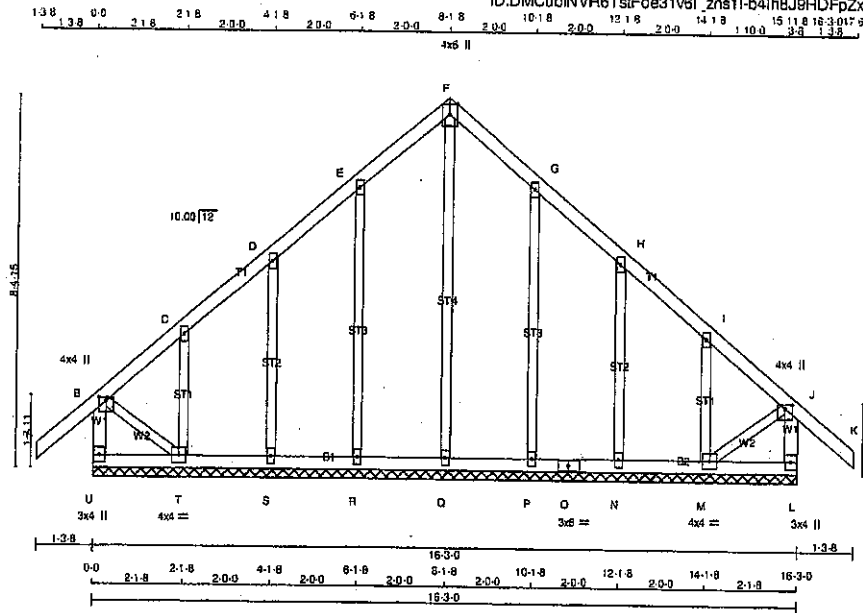

CHORDS	SIZE	DRY	No.2
A - F	2x4	DRY	No.2
F - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2

ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table in inches)	W	LEN	Y	X
B TMW+p MT20	4.0	4.0	1.00	2.00
C, D, E, G, H, I				
C TMW+w MT20	2.0	4.0		
F TTW+p MT20	4.0	8.0	Edge	
J TMW+p MT20	4.0	4.0	1.00	2.00
L BMV1+p MT20	3.0	4.0		
M BMW1+ MT20	4.0	4.0		
N, P, Q, R, S				
N BMW1+w MT20	2.0	4.0		
O BS+ MT20	3.0	8.0		
T BMW1+ MT20	4.0	4.0		
U BMV1+p MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PL)	MAX. FACTORED CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PL)	MAX. FACTORED CS1 (LC)
FR-TO				FR-TO			
A-B	0/41	-91.8	-91.8 0.13 (1)	Q-F	-124/0	0.17 (1)	0.17 (1)
B-C	-28/0	-91.8	-91.8 0.05 (1)	R-E	-210/0	0.16 (1)	0.16 (1)
C-D	-36/0	-91.8	-91.8 0.05 (1)	S-D	-169/0	0.06 (1)	0.06 (1)
D-E	-24/0	-91.8	-91.8 0.05 (1)	T-C	-205/0	0.04 (1)	0.04 (1)
E-F	-36/0	-91.8	-91.8 0.05 (1)	P-G	-210/0	0.16 (1)	0.16 (1)
F-G	-36/0	-91.8	-91.8 0.05 (1)	N-H	-169/0	0.06 (1)	0.06 (1)
G-H	-24/0	-91.8	-91.8 0.05 (1)	M-I	-205/0	0.04 (1)	0.04 (1)
H-I	-36/0	-91.8	-91.8 0.05 (1)	B-T	0/37	0.01 (1)	0.01 (1)
I-J	-28/0	-91.8	-91.8 0.05 (1)	M-J	0/37	0.01 (1)	0.01 (1)
J-K	0/41	-91.8	-91.8 0.13 (1)				
U-B	-246/0	0.0	0.0 0.03 (1)				
L-J	-246/0	0.0	0.0 0.03 (1)				
U-T	0/0	-18.5	-18.5 0.02 (4)				
T-S	0/25	-18.5	-18.5 0.02 (4)				
S-R	0/21	-18.5	-18.5 0.02 (4)				
R-Q	0/18	-18.5	-18.5 0.02 (4)				
Q-P	0/18	-18.5	-18.5 0.02 (4)				
P-O	0/21	-18.5	-18.5 0.02 (4)				
O-N	0/21	-18.5	-18.5 0.02 (4)				
N-M	0/25	-18.5	-18.5 0.02 (4)				
M-L	0/0	-18.5	-18.5 0.02 (4)				

TOTAL WEIGHT = 81 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2015, CBC 2012, ABC 2019

- PART 9 OF CBC 2012 (2019 AMENDMENT)

- CSA 086-03, CSA 086-14

- TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS1: TC=0.13/1.00 (A-B:1), BC=0.02/1.00 (M-N:4), WB=0.17/1.00 (F-G:1), SS=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 618 354 1667 768 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.52 (T) (INPUT = 0.90)

JSI METAL= 0.11 (G) (INPUT = 1.00)

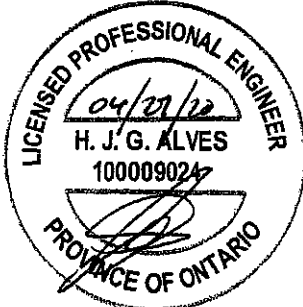


Structural component only
DWG# T-2007123

JOB NAME 408168	TRUSS NAME T10	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:59 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns11-Xjys8cOCi4DsIFFNQo?7nUGOUQrOpqhSUZ?XJzNBRA

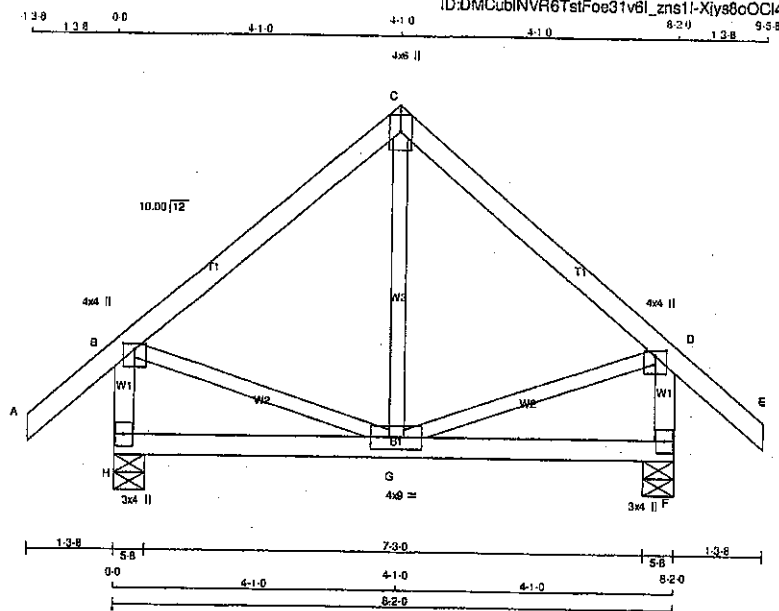

Scale = 1/32

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	DRY	No.2
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - D	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW+p	MT20	4.0	8.0	Edge	
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW+p	MT20	4.0	9.0		
H	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	
JT	VERT	HORZ	DOWN	HORZ
H	577	0	577	0
F	577	0	577	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS
H	COMBINED	SNOW	LIVE
F	COMBINED	SNOW	LIVE
H	406	280 / 0	0 / 0
F	406	280 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	WEBS	MAX. FACTORED
		FORCE	VERT.	PLF	CSI	LC	UNBRAC			FORCE
FR-TO		(LBS)	FROM	TO	LENGTH	FR-TO				(LBS)
A-B		9 / 41	-91.8	-91.8	0.13 (1)	10.00	G-C		-37 / 57	0.02 (4)
B-C		-264 / 0	-91.8	-91.8	0.20 (1)	6.25	B-G		0 / 213	0.05 (1)
C-D		-264 / 0	-91.8	-91.8	0.20 (1)	6.25	G-D		0 / 213	0.05 (1)
D-E		0 / 41	-91.8	-91.8	0.13 (1)	10.00				
H-B		-548 / 0	0.0	0.0	0.06 (1)	7.81				
F-D		-548 / 0	0.0	0.0	0.06 (1)	7.81				
H-G		0 / 0	-18.5	-18.5	0.09 (4)	10.00				
G-F		0 / 0	-18.5	-18.5	0.09 (4)	10.00				

TOTAL WEIGHT = 38 lb

MTF

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.27")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.27")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TO=0.20/1.00 (B-C:1), BC=0.09/1.00 (F-G:4),
WB=0.05/1.00 (D-G:1), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	
MAX	MIN	MAX	MIN
MT20	618	354	1657

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.46 (D) (INPUT = 0.80)
JSI METAL= 0.12 (D) (INPUT = 1.00)

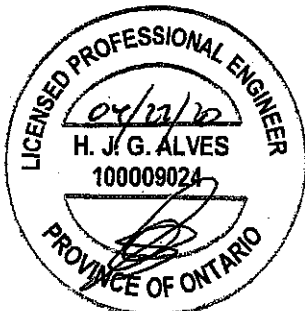


Structural component only
DWG# T-2007139

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408168	G10	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:34:41 2020 Page 1
ID:DMCubINVR6TsFoe31v6I_zns11-3Gs3MeAv_YyQYUtwN0gv2hWL7AJCchL2JgC3vMzNBRS

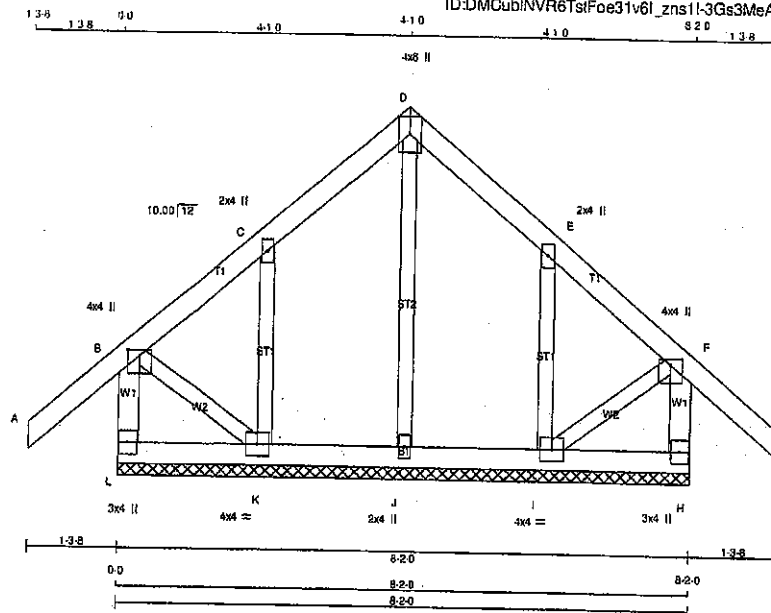

Scale = 1/25.0

LUMBER				
N. L. G. A. RULES				
CHORDS		SIZE	LUMBER	
L - B	2x4	DRY	No.2	
A - O	2x4	DRY	No.2	
D - G	2x4	DRY	No.2	
H - F	2x4	DRY	No.2	
L - H	2x4	DRY	No.2	
ALL WEBS	2x3	DRY	No.2	
ALL GABLE WEBS	2x3	DRY	No.2	
DRY: SEASONED LUMBER.				

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C TMW+w	MT20	2.0	4.0		
D TTW+p	MT20	4.0	6.0	Edge	
E TMW+w	MT20	2.0	4.0		
F TMVW+p	MT20	4.0	4.0	1.00	2.00
H BMV1+p	MT20	3.0	4.0		
I BMW1+p	MT20	4.0	4.0		
J BMW1+p	MT20	2.0	4.0		
K BMW1+p	MT20	4.0	4.0		
L BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
L-B	-224 / 0	0.0 0.0	0.02 (1)	J-D	-126 / 0	0.05 (1)	
A-B	0 / 41	-91.8 -91.8	0.13 (1)	K-C	-227 / 0	0.04 (1)	
B-C	-11 / 0	-91.8 -91.8	0.08 (1)	I-E	-227 / 0	0.04 (1)	
C-D	-31 / 0	-91.8 -91.8	0.05 (1)	B-K	0 / 24	0.01 (1)	
D-E	-31 / 0	-91.8 -91.8	0.05 (1)	I-F	0 / 24	0.01 (1)	
E-F	-11 / 0	-91.8 -91.8	0.08 (1)				
F-G	0 / 41	-91.8 -91.8	0.13 (1)				
H-F	-224 / 0	0.0 0.0	0.02 (1)				
L-K	0 / 0	-18.5 -18.5	0.02 (4)				
K-J	0 / 13	-18.5 -18.5	0.02 (4)				
J-I	0 / 13	-18.5 -18.5	0.02 (4)				
I-H	0 / 0	-18.5 -18.5	0.02 (4)				

TOTAL WEIGHT = 40 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.8 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(56% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TO=0.13/1.00 (A-B:1), BC=0.02/1.00 (J-K:4), WB=0.05/1.00 (D-J:1), SS=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (ORY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1687 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (C) (INPUT = 0.80)
JSI METAL= 0.12 (C) (INPUT = 1.00)

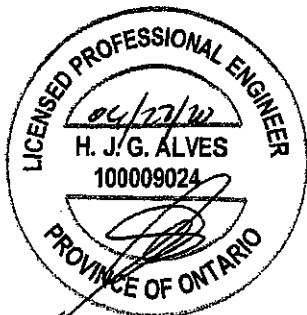


Structural component only
DWG# T-2007124

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408168	T11	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.3.10 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:35:00 2020 Page 1
ID:DMCubINVR6TstFos31v6l_zns1f-7wWEL8PqVCLIKPQa_WWWJhoZlq8hYBarh8IZ4izNB8R9

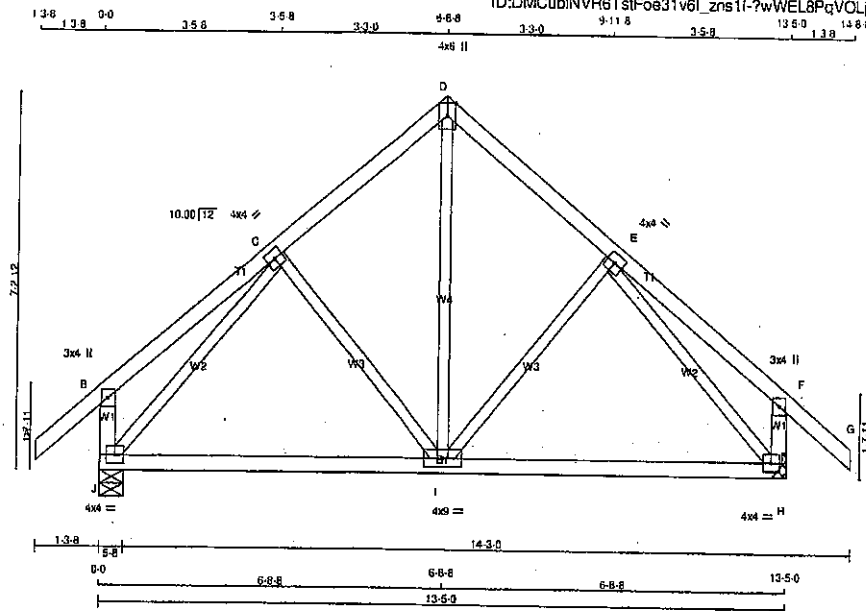

Scale = 1/40.5

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0	
C	TMVW-t	MT20	4.0	4.0	
D	TTW-p	MT20	4.0	6.0	Edge
E	TMVW-t	MT20	4.0	4.0	
F	TMV-p	MT20	3.0	4.0	
H	BMVW1-t	MT20	4.0	4.0	
I	BMVW1-t	MT20	4.0	9.0	
J	BMVW1-t	MT20	4.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	DOWN	UP	IN-SX
J	887	0	0	5-8
H	887	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
J	811	414/0 0/0 0/0 0/0 198/0 0/0
H	811	414/0 0/0 0/0 0/0 198/0 0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/41	-91.8 -91.8	0.13 (1)	10.00	I-D	0/382	0.09 (1)
B-C	0/23	-91.8 -91.8	0.16 (1)	10.00	I-E	-149/0	0.07 (1)
C-D	-509/0	-91.8 -91.8	0.13 (1)	6.25	C-I	-149/0	0.07 (1)
D-E	-509/0	-91.8 -91.8	0.13 (1)	6.25	J-C	-742/0	0.33 (1)
E-F	0/23	-91.8 -91.8	0.16 (1)	10.00	E-H	-742/0	0.33 (1)
F-G	0/41	-91.8 -91.8	0.13 (1)	10.00			
J-B	-244/0	0.0 0.0	0.03 (1)	7.81			
H-F	-244/0	0.0 0.0	0.03 (1)	7.81			
J-I	0/489	-18.5 -18.5	0.27 (4)	10.00			
I-H	0/489	-18.5 -18.5	0.27 (4)	10.00			

TOTAL WEIGHT = 3 X 64 = 191 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 38.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.48")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.48")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.05")

CSI: TC=0.16/1.00 (E-F:1), BC=0.27/1.00 (I-J:4), WB=0.39/1.00 (E-H:1), SSI=0.11/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1967 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.84 (E) (INPUT = 0.90)
JSI METAL = 0.27 (E) (INPUT = 1.00)

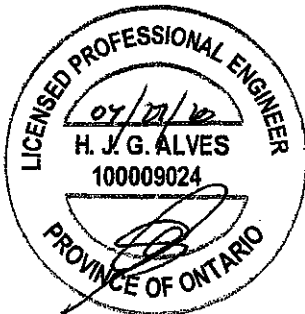

Structural component only
DWG# T-2007140

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	G11	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
TRUSS DESC.					

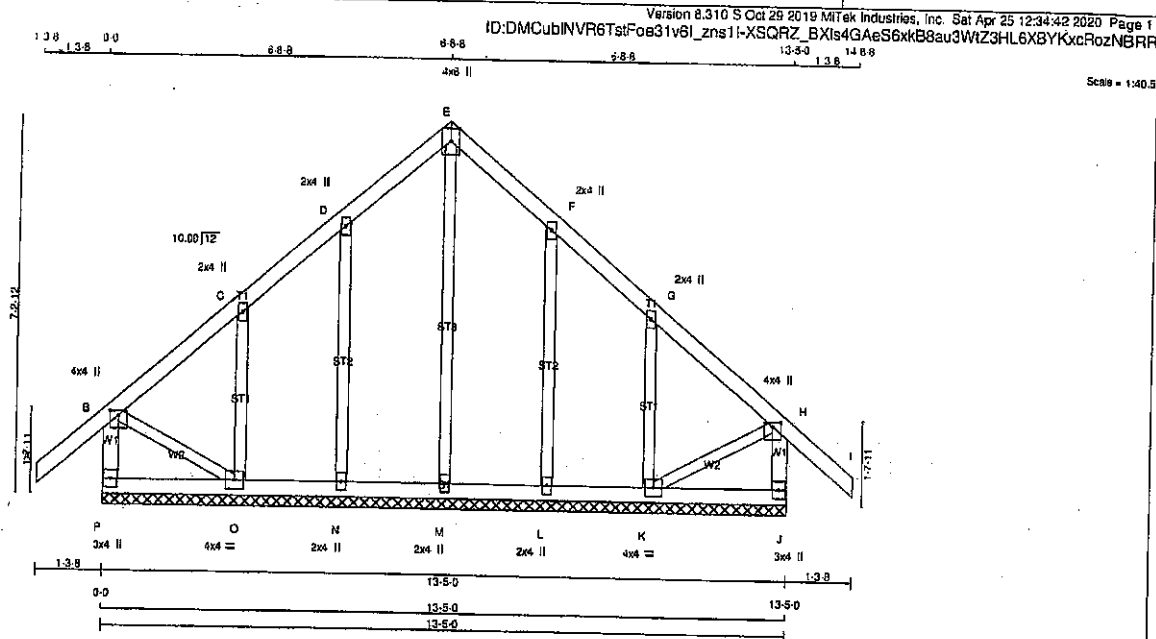

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
P - B	2x4	DRY	No.2
A - E	2x4	DRY	No.2
E - I	2x4	DRY	No.2
J - H	2x4	DRY	No.2
P - J	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
ALL GABLE WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C, D, F, G					
C TMVW+w	MT20	2.0	4.0		
E TTW+p	MT20	4.0	6.0	Edge	
H TMVW+p	MT20	4.0	4.0	1.00	2.00
J BMV1+p	MT20	3.0	4.0		
K BMVW1-t	MT20	4.0	4.0		
L, M, N					
L BMV1+w	MT20	2.0	4.0		
O BMVW1-t	MT20	4.0	4.0		
P BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	UNBRACED LENGTH	MEMB.	WEBS MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
P-B	-263 / 0	0.0 0.0	0.03 (1)	7.81	M-E	-128 / 0	0.11 (1)
A-B	0 / 41	-91.8 -91.8	0.13 (1)	10.00	N-D	-190 / 0	0.09 (1)
B-C	-24 / 0	-91.8 -91.8	0.08 (1)	8.25	O-C	-239 / 0	0.08 (1)
C-D	-35 / 0	-91.8 -91.8	0.08 (1)	8.25	L-F	-190 / 0	0.09 (1)
D-E	-35 / 0	-91.8 -91.8	0.05 (1)	8.25	K-G	-239 / 0	0.08 (1)
E-F	-35 / 0	-91.8 -91.8	0.05 (1)	8.25	B-O	0 / 32	0.01 (1)
F-G	-36 / 0	-91.8 -91.8	0.08 (1)	8.25	K-H	0 / 32	0.01 (1)
G-H	-24 / 0	-91.8 -91.8	0.08 (1)	10.00			
H-I	0 / 41	-91.8 -91.8	0.13 (1)	7.81			
J-H	-263 / 0	0.0 0.0	0.03 (1)	7.81			
P-O	0 / 0	-18.5 -18.5	0.03 (4)	10.00			
O-N	0 / 22	-18.5 -18.5	0.03 (4)	10.00			
N-M	0 / 19	-18.5 -18.5	0.02 (4)	10.00			
M-L	0 / 19	-18.5 -18.5	0.02 (4)	10.00			
L-K	0 / 22	-18.5 -18.5	0.03 (4)	10.00			
K-J	0 / 0	-18.5 -18.5	0.03 (4)	10.00			

TOTAL WEIGHT = 65 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (H-L), BC=0.03/1.00 (K-L), WB=0.11/1.00 (E-M), SSI=0.08/1.00 (G-H)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1667 788	1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.20 (B) (INPUT = 0.90)
JSI METAL= 0.13 (G) (INPUT = 1.00)




Structural component only
DWG# T-2007125

JOB NAME 408168	TRUSS NAME T12	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:35:01 2020 Page 1
 ID:DMCubINVR6TstFoe31v6I_zns1I-T63dYUPSGITayZPmYD1bsvLjXEW1Hhl_vn26cCZNBRS



Scale = 1:18.8

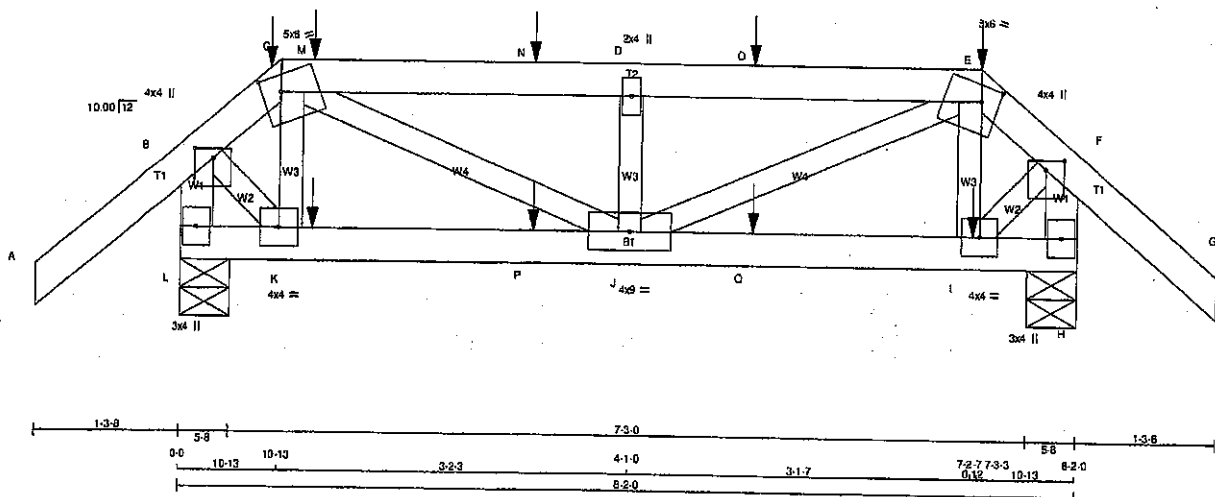

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF
 EXCEPT
 DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW+p	MT20	4.0	4.0 1.00 2.00
C	TTWW-m	MT20	5.0	5.0 1.75 2.00
D	TMW+w	MT20	2.0	4.0
E	TTWW-m	MT20	5.0	5.0 1.75 2.00
F	TMVW+p	MT20	4.0	4.0 1.00 2.00
H	BMV1+p	MT20	3.0	4.0
I	BMVW-t	MT20	4.0	4.0
J	BMVW-t	MT20	4.0	4.0
K	BMVW-t	MT20	4.0	4.0
L	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	REQRD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	UPLIFT
L	913	0	0
H	911	0	0

UNFACTORED REACTIONS						
1ST CASE	MAX/MIN	COMPONENT	REACTIONS			
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
L	642	442 / 0	0 / 0	0 / 0	0 / 0	199 / 0
H	641	437 / 0	0 / 0	0 / 0	0 / 0	204 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.82 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)
A-B	0 / 41	-91.8	-91.8 0.14 (1)
B-C	-831 / 0	-91.8	-91.8 0.14 (1)
C-M	-1054 / 0	-91.8	-91.8 0.23 (1)
M-N	-1054 / 0	-91.8	-91.8 0.23 (1)
N-D	-1054 / 0	-91.8	-91.8 0.23 (1)
D-O	-1054 / 0	-91.8	-91.8 0.23 (1)
O-E	-1054 / 0	-91.8	-91.8 0.23 (1)
E-F	-832 / 0	-91.8	-91.8 0.14 (1)
F-G	0 / 41	-91.8	-91.8 0.14 (1)
L-B	-938 / 0	0.0	0.0 0.10 (1)
H-F	-937 / 0	0.0	0.0 0.10 (1)
L-K	0 / 0	-18.5	-18.5 0.05 (1)
K-P	0 / 420	-18.5	-18.5 0.13 (1)
P-J	0 / 420	-18.5	-18.5 0.13 (1)
J-Q	0 / 421	-18.5	-18.5 0.14 (1)
Q-I	0 / 421	-18.5	-18.5 0.14 (1)
I-H	0 / 0	-18.5	-18.5 0.05 (1)

FACTORED CONCENTRATED LOADS (LBS)			
JT	LOC.	LC1	MAX- MAX+
C	10-13	-9	-10
C	1-2.7	-114	-114
C	10-13	-44	-44
E	7-3.3	-9	-10
E	7-3.3	-90	-90
E	7-3.3	-44	-44
I	7-2.7	-49	-49
K	1-2.7	-49	-49
N	3-2.7	-82	-82
O	5-2.7	-82	-82
P	3-2.7	-49	-49
Q	5-2.7	-49	-49

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
 GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
 LOADS WERE DERIVED FROM USER INPUT
 NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
 ADDTL. USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 085-14
 - TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
 - OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.27")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
 ALLOWABLE DEFL.(TL) = L/360 (0.27")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.23/1.00 (C-D:1), BC=0.14/1.00 (J-I:1), WB=0.17/1.00 (C-J:1), SS=0.22/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1667 1655

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

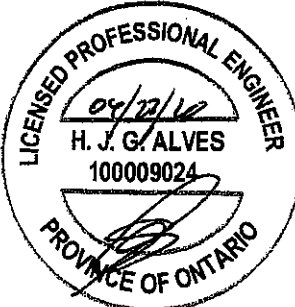


Structural component only
 DWG# T-2007141

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408168	T13	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITK Industries, Inc. Sat Apr 25 12:35:03 2020 Page 1
ID:DMCubINVR6Tstfoc31vbl_zns1I-PVBNzARioJIBsZ9f33xKQvZ1CWYJHNSXDq4zNBR6

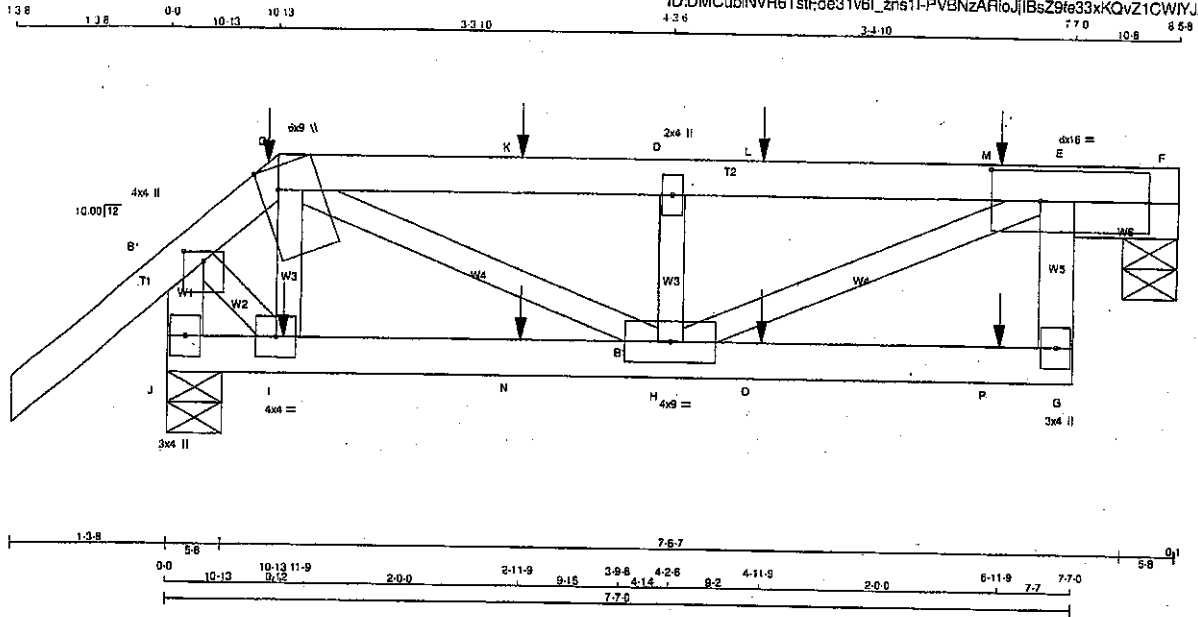

TOTAL WEIGHT = 32 lb

LUMBER	CHORDS	SIZE	DRY	LUMBER
N. L. G. A. RULES	A - C	2x4	DRY	No.2
	C - F	2x4	DRY	No.2
	E - F	2x4	DRY	No.2
	G - E	2x4	DRY	No.2
	J - B	2x4	DRY	No.2
	J - G	2x4	DRY	No.2

ALL WEBS 2x3 DRY SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTWW+m	MT20	6.0	9.0	Edge	1.75
D	TMW+w	MT20	2.0	4.0		
E	TMVWW-i	MT20	6.0	16.0	3.00	5.00
G	BMV+p	MT20	3.0	4.0		
H	BMVWW-i	MT20	4.0	9.0		
I	BMVW-i	MT20	4.0	4.0		
J	BMV+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
F	695	895	5-8	5-8
J	936	936	5-8	5-8

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): F

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	490	327 / 0	0 / 0	0 / 0	0 / 0	163 / 0	0 / 0	0 / 0
J	659	449 / 0	0 / 0	0 / 0	0 / 0	210 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.56 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC)	
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 41	-91.8	-91.8	0.14 (1)	10.00	I-C	-158 / 0
B-C	-856 / 0	-91.8	-91.8	0.14 (1)	6.25	B-I	0 / 548
C-K	-1230 / 0	-91.8	-91.8	0.46 (1)	5.09	H-D	-767 / 0
K-D	-1230 / 0	-91.8	-91.8	0.46 (1)	5.09	C-H	0 / 867
D-L	-1230 / 0	-91.8	-91.8	0.89 (1)	3.56	H-E	0 / 1345
L-M	-1230 / 0	-91.8	-91.8	0.89 (1)	3.56		
M-E	-1230 / 0	-91.8	-91.8	0.89 (1)	3.56		
E-F	0 / 0	-91.8	-91.8	0.35 (1)	10.00		
G-E	0 / 83	0.0	0.0	0.02 (4)	10.00		
J-B	-965 / 0	0.0	0.0	0.11 (1)	7.81		
J-I	0 / 0	-18.5	-18.5	0.06 (1)	10.00		
I-N	0 / 438	-18.5	-18.5	0.14 (1)	10.00		
N-H	0 / 438	-18.5	-18.5	0.14 (1)	10.00		
H-O	0 / 0	-18.5	-18.5	0.09 (1)	10.00		
O-P	0 / 0	-18.5	-18.5	0.09 (1)	10.00		
P-G	0 / 0	-18.5	-18.5	0.09 (1)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	10-13	-9	-10	---	FRONT	VERT	DEAD	---	C1
C	10-13	-90	-90	---	FRONT	VERT	TOTAL	---	C1
C	10-13	-44	-44	---	FRONT	VERT	SNOW	---	C1
I	11-9	-49	-49	---	FRONT	VERT	TOTAL	---	C1
K	2-11-9	-82	-82	---	FRONT	VERT	TOTAL	---	C1
L	4-11-9	-82	-82	---	FRONT	VERT	TOTAL	---	C1
M	6-11-9	-82	-82	---	FRONT	VERT	TOTAL	---	C1
N	2-11-9	-49	-49	---	FRONT	VERT	TOTAL	---	C1
O	4-11-9	-49	-49	---	FRONT	VERT	TOTAL	---	C1
P	6-11-9	-53	-53	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) CT: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT.
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
DL	= 6.0	PSF	
BOT CH.	LL	= 0.0	PSF
DL	= 7.4	PSF	
TOTAL LOAD	= 39.0	PSF	

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.25")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (0.25")
CALCULATED VERT. DEFL.(TL) = L/888 (0.13")

CSI: TC=0.89/1.00 (D-E:1), SC=0.14/1.00 (H-I:1),
WB=0.33/1.00 (E-H:1), SSI=0.42/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	818	354	1667 788 1987 1655

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.79 (C) (INPUT = 0.90)
JSI METAL= 0.30 (H) (INPUT = 1.00)



Structural component only
DWG# T-2007142

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 12:49:24 2020 Page 1
ID:K?TPdhgJOnplqYbWIOFzIdG-8Igasn1sB7_Budbz0zKub486zN_xr0MZbH0GzNB0f

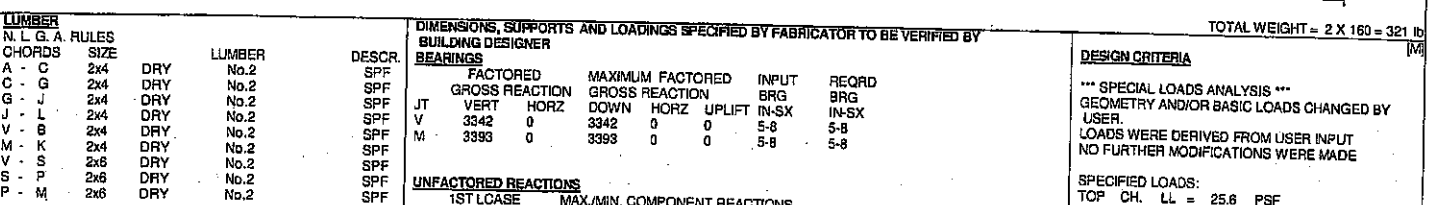

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

[illegible]

PROFESSIONAL



LICENÇA DE CONDUTIVA
H. J. G. ALVES
100009024

100002024

PR 10



PROVINCE OF ONTARIO

Structural component only
DWG# T 2003145 16

BWG# 1-2007 143 72

BEARINGS			
FACTORED	MAXIMUM FACTORED	INLET	ROOST

UNFACTORED REACTIONS
1ST LOASE MAX/MIN. COMPONENT REACTIONS

	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SC
V	2363	1555 / 0	0 / 0	0 / 0	0 / 0	808 / 0	0 / 0
M	2187	1585 / 0	0 / 0	0 / 0	0 / 0	808 / 0	0 / 0

BRACING

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE A STEEP SLOPE

LOADING
TOTAL LOAD CASES: 11

MEMB. FORCE FACTORED WEBS MAX. FACTORED

AI	0 / 0	-18.5	-18.5	0.05 (4)	10.00
UJ	0 / 0	-18.5	-18.5	0.05 (4)	10.00
UJ	0 / 0	-18.5	-18.5	0.05 (4)	10.00
AK	0 / 3265	-18.5	-18.5	0.25 (1)	10.00
AL	0 / 3265	-18.5	-18.5	0.25 (1)	10.00
AM	0 / 3265	-18.5	-18.5	0.25 (1)	10.00
-T	0 / 3265	-18.5	-18.5	0.25 (1)	10.00
AN	0 / 8186	-18.5	-18.5	0.46 (1)	10.00
-S	0 / 8186	-18.5	-18.5	0.46 (1)	10.00
R	0 / 8186	-18.5	-18.5	0.46 (1)	10.00
RP	0 / 7608	-18.5	-18.5	0.46 (1)	10.00
AQ	0 / 7608	-18.5	-18.5	0.56 (1)	10.00
AR	0 / 7608	-18.5	-18.5	0.56 (1)	10.00
Q	0 / 7608	-18.5	-18.5	0.56 (1)	10.00
P	0 / 8217	-18.5	-18.5	0.46 (1)	10.00
IS	0 / 8217	-18.5	-18.5	0.46 (1)	10.00

DESIGN CRITERIA

GEOMETRY AND/OR BASIC LOADS CHANGED BY USER

SPECIFIED LOADS:

BOT	CH.	LL	=	0.0	PSF
		DI	=	7.4	PSF

SPACING = 24.0 IN. C/C

OF 6.00/12

LOAD CASES.

NBCC 2010, NBCC 2015

- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF

ALLOWABLE DEFL.(LL) = $L/360$ (1.17")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.23")

CSI: TC=0.71/1.00 (D-E:1), BC=0.58/1.00 (Q-R:1).

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

TOLUOL DI AZE MITTILKATION

CRUSS MANUFACTURING PLANT.

	(FSI)	(FL)	(PL)
	MAX MIN	MAX MIN	MAX MIN
AT70	519 554	1055 805	1055 805

PLATE ROTATION TOL. = 5.0 deg

SI METAL= 0.59 (S) {INPUT = 1.00 }

1000

CONTINUED ON PAGE 2

PLATES (table is in inches)

PLATE	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.50	3.50
C	TTWW-m	MT20	6.0	9.0	Edge	6.25
D	TMVW-t	MT20	4.0	6.0		
E	TMVW-w	MT20	2.0	4.0		
F	TMVW-t	MT20	4.0	4.0		
G	TS-t	MT20	3.0	8.0		
H	TMVW-w	MT20	2.0	4.0		
I	TMVW-t	MT20	4.0	5.0		
J	TTWW-m	MT20	6.0	9.0	Edge	6.25
K	TMVW-p	MT20	5.0	8.0	1.50	3.50
M	BMV1-p	MT20	3.0	8.0		
N	BMVW-t	MT20	5.0	6.0	2.50	2.00
O	BMVW-t	MT20	6.0	9.0	4.50	2.00
P	BS-t	MT20	5.0	6.0		
Q	BMVWW-t	MT20	5.0	8.0		
R	BMVWW-t	MT20	5.0	8.0		
S	BS-t	MT20	5.0	6.0		
T	BMVW-t	MT20	6.0	9.0	4.50	2.00
U	BMVW-t	MT20	5.0	6.0	2.50	2.00
V	BMV1-p	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FROM	TO				
AS-AT	0 / 6217	-18.5	-18.5	0.46 (1)	10.00		
AT-O	0 / 6217	-18.5	-18.5	0.46 (1)	10.00		
O-AU	0 / 3326	-18.5	-18.5	0.26 (1)	10.00		
AU-AV	0 / 3326	-18.5	-18.5	0.26 (1)	10.00		
AV-N	0 / 3326	-18.5	-18.5	0.26 (1)	10.00		
N-AW	0 / 0	-18.5	-18.5	0.04 (4)	10.00		
AW-M	0 / 0	-18.5	-18.5	0.04 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
JT	4-0-11	-49	-55	FRONT	VERT	DEAD	---	C1
C	4-0-11	-264	-254	FRONT	VERT	SNOW	---	C1
G	19-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
J	31-1-6	-49	-55	FRONT	VERT	DEAD	---	C1
J	31-1-6	-117	-117	BACK	VERT	TOTAL	---	C1
J	31-1-6	-254	-254	FRONT	VERT	SNOW	---	C1
N	31-2-12	-28	-28	BACK	VERT	TOTAL	---	C1
P	21-2-12	-28	-28	BACK	VERT	TOTAL	---	C1
W	5-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
X	7-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
Y	9-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
Z	11-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
AA	13-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
AB	15-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
AC	17-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
AD	21-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
AE	23-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
AF	25-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
AG	27-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
AH	29-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
AI	1-2-12	-28	-28	BACK	VERT	TOTAL	---	C1
AJ	3-2-12	-28	-28	BACK	VERT	TOTAL	---	C1
AK	5-2-12	-28	-28	BACK	VERT	TOTAL	---	C1
AL	7-2-12	-28	-28	BACK	VERT	TOTAL	---	C1
AM	9-2-12	-28	-28	BACK	VERT	TOTAL	---	C1
AN	11-2-12	-28	-28	BACK	VERT	TOTAL	---	C1
AO	13-2-12	-28	-28	BACK	VERT	TOTAL	---	C1
AP	15-2-12	-28	-28	BACK	VERT	TOTAL	---	C1
AQ	17-2-12	-28	-28	BACK	VERT	TOTAL	---	C1
AR	19-2-12	-28	-28	BACK	VERT	TOTAL	---	C1
AS	23-2-12	-28	-28	BACK	VERT	TOTAL	---	C1
AT	25-2-12	-28	-28	BACK	VERT	TOTAL	---	C1
AU	27-2-12	-28	-28	BACK	VERT	TOTAL	---	C1
AV	29-2-12	-28	-28	BACK	VERT	TOTAL	---	C1
AW	33-2-12	-28	-28	BACK	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T20Z	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington	Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:25 2020 Page 1
1 3.8 0-0 4-0-11 4-0-11 5-5-11 9-4-6 5-4-7 14-10-13 28-4 17-7-0 20-3-3 25-7-11 37-6-12 28-4-12 31-1-8 31-8-12 35-2-0 38-5-8 1 3.8 1 3.8	ID:K?TPdngj0npl1qYdbWfOfZdeG-AKHFWtPo9K_cKTP9gXC67DKWF2Jk9bCKqW7zNBDe
	Scale = 1:57.3

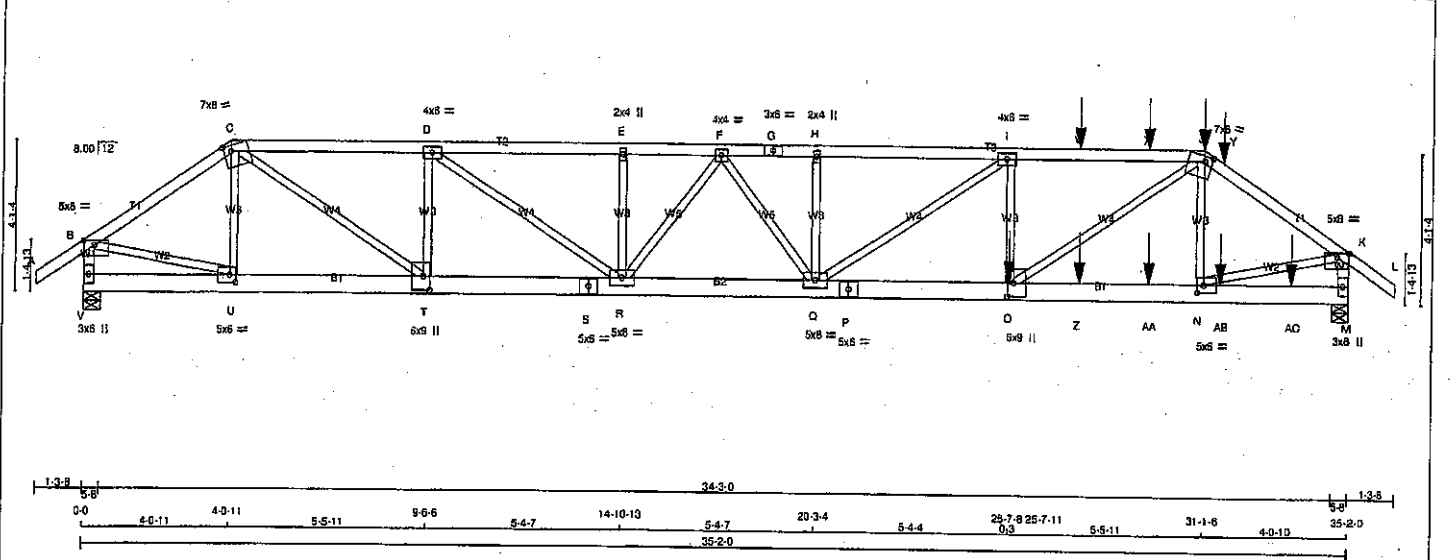

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES	A - C	2x4	DRY	No.2
	C - G	2x4	DRY	No.2
	G - J	2x4	DRY	No.2
	J - L	2x4	DRY	No.2
	L - B	2x4	DRY	No.2
	M - K	2x4	DRY	No.2
	V - S	2x6	DRY	No.2
	S - P	2x6	DRY	No.2
	P - M	2x6	DRY	No.2
	ALL WEBS	2x3	DRY	No.2
	EXCEPT			SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
C - G	12	TOP
G - J	12	SIDE(81.0)
J - L	12	SIDE(81.0)
L - B	12	TOP
M - K	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
V - S	12	TOP
S - P	12	TOP
P - M	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	SIDE(557.9)
I - O	1	
D - T	1	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT IN-SX	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
V	2938	0	2938	0
M	4796	0	4796	0

UNFACTORED REACTIONS	1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
V	2073	1388 / 0	0 / 0
M	3361	2278 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.57 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO						FR-TO			
A-B	0 / 35	-91.8	-91.8	0.07 (1)	10.00	U-C	-584 / 0	0.07 (1)	
B-C	-3442 / 0	-91.8	-91.8	0.20 (1)	4.86	C-T	0 / 3700	0.46 (1)	
C-D	-5905 / 0	-91.8	-91.8	0.43 (1)	3.70	T-D	-1983 / 0	0.25 (1)	
D-E	-7947 / 0	-91.8	-91.8	0.58 (1)	3.11	D-R	0 / 2485	0.31 (1)	
E-F	-7947 / 0	-91.8	-91.8	0.31 (1)	3.30	R-E	-388 / 0	0.05 (1)	
F-G	-9222 / 0	-91.8	-91.8	0.58 (1)	3.01	Q-H	-346 / 0	0.04 (1)	
G-H	-9222 / 0	-91.8	-91.8	0.38 (1)	3.01	Q-I	-503 / 0	0.19 (1)	
H-I	-9222 / 0	-91.8	-91.8	0.77 (1)	2.73	Q-J	-397 / 0	0.05 (1)	
I-W	-9835 / 0	-91.8	-91.8	0.88 (1)	2.57	C-J	0 / 5776	0.71 (1)	
W-X	-9835 / 0	-91.8	-91.8	0.88 (1)	2.57	N-J	-915 / 0	0.12 (1)	
X-J	-9835 / 0	-91.8	-91.8	0.88 (1)	2.57	B-U	0 / 2940	0.36 (1)	
J-Y	-5847 / 0	-91.8	-91.8	0.33 (1)	3.78	N-K	0 / 5020	0.82 (1)	
Y-K	-5847 / 0	-91.8	-91.8	0.33 (1)	3.78	R-F	-1209 / 0	0.21 (1)	
K-L	0 / 35	-91.8	-91.8	0.07 (1)	10.00	F-Q	0 / 974	0.12 (1)	
V-B	-2914 / 0	0.0	0.0	0.15 (1)	6.74				
M-K	-4771 / 0	0.0	0.0	0.27 (1)	5.48				

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
J	31-1-6	-49	-55	---	---	FRONT	VERT	DEAD	---	C1
O	31-1-6	-254	-254	---	---	FRONT	VERT	SNOW	---	C1
J	25-7-8	-2840	-2840	---	---	FRONT	VERT	TOTAL	---	C1
W	27-6-12	-110	-110	---	---	FRONT	VERT	TOTAL	---	C1
X	29-6-12	-110	-110	---	---	FRONT	VERT	TOTAL	---	C1
Y	31-6-12	-136	-136	---	---	FRONT	VERT	TOTAL	---	C1
Z	27-6-12	-26	-26	---	---	FRONT	VERT	TOTAL	---	C1
AA	29-6-12	-26	-26	---	---	FRONT	VERT	TOTAL	---	C1
AB	31-6-12	-26	-26	---	---	FRONT	VERT	TOTAL	---	C1
AC	33-6-12	-26	-26	---	---	FRONT	VERT	TOTAL	---	C1

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***

GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.

LOADS WERE DERIVED FROM USER INPUT

NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 085-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")

CALCULATED VERT. DEFL.(LL) = U/599 (0.28")

ALLOWABLE DEFL.(TL) = L/360 (1.17")

CALCULATED VERT. DEFL.(TL) = U/832 (0.51")

CSI: TC=0.88/1.00 (I-J:1), BC=0.72/1.00 (C-Q:1), WB=0.71/1.00 (J-Q:1), SSI=0.18/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (C) (INPUT = 0.80)

JSI METAL = 0.87 (S) (INPUT = 1.00)



Structural component only

DWG# T-2007146 112

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T20Z	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:49:25 2020 Page 2
ID:K7TPdngi0npl1qYdbWfOFzideG-AKHFWuIPo9K ckTp9gXCi67DKWF2Jk9bCKgw7znNBDe

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.50	3.50
C	TTWW-m	MT20	7.0	8.0	1.75	2.50
D	TMWW-l	MT20	4.0	6.0		
E	TMW+w	MT20	2.0	4.0		
F	TMWW-t	MT20	4.0	4.0		
G	TS-l	MT20	3.0	6.0		
H	TMW+w	MT20	2.0	4.0		
I	TMWW-l	MT20	4.0	6.0		
J	TTWW-m	MT20	7.0	8.0	1.75	2.50
K	TMVW-p	MT20	5.0	8.0	1.50	3.50
M	BMV1+p	MT20	3.0	6.0		
N	BMWW-l	MT20	5.0	8.0	2.50	2.00
O	BMWW-t	MT20	6.0	9.0	4.50	2.00
P	BS-l	MT20	5.0	6.0		
Q	BMWWW-l	MT20	5.0	8.0		
R	BMWWW-l	MT20	5.0	8.0		
S	BS-l	MT20	5.0	6.0		
T	BMWW-t	MT20	6.0	9.0	4.50	2.00
U	BMWW-l	MT20	5.0	6.0	2.50	2.00
V	BMV1+p	MT20	3.0	6.0		

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007146

42

JOB NAME 408169	TRUSS NAME T21	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

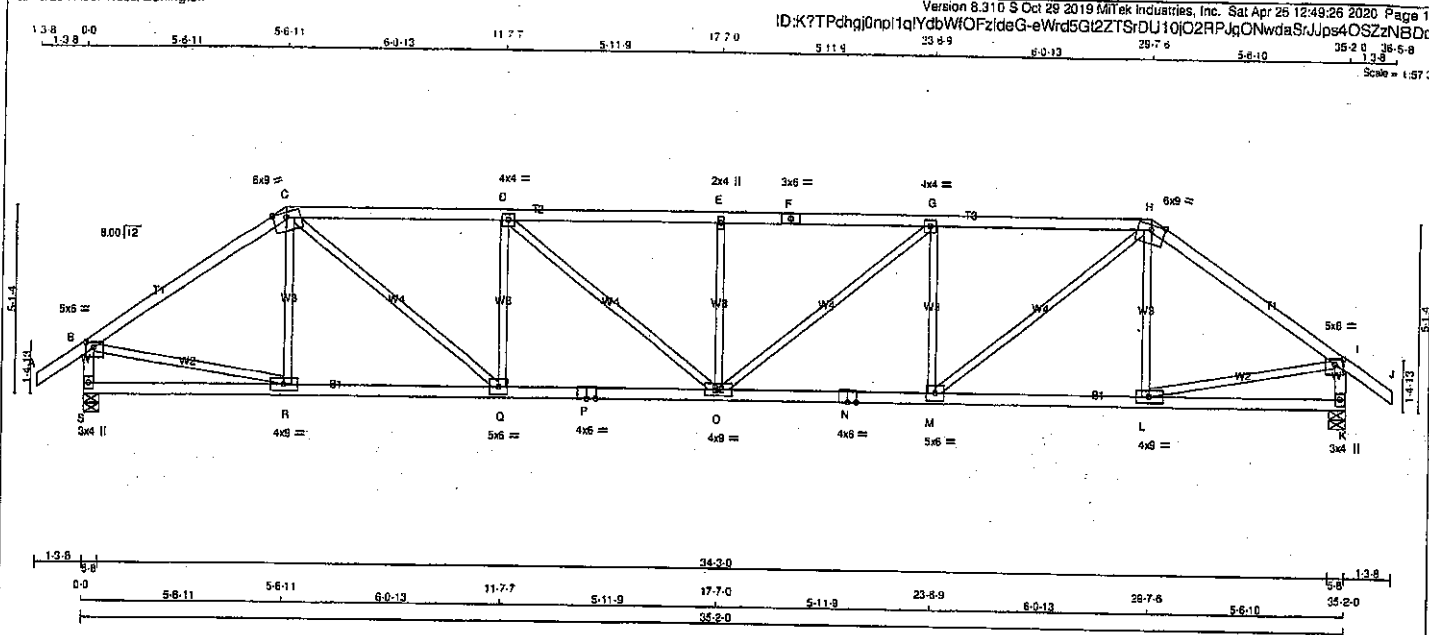

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER A - C 2x4 DRY No.2 C - F 2x4 DRY No.2 F - H 2x4 DRY No.2 H - J 2x4 DRY No.2 K - L 2x4 DRY No.2 S - P 2x4 DRY No.2 P - N 2x4 DRY No.2 N - K 2x4 DRY No.2 ALL WEBS 2x3 DRY No.2 EXCEPT DRY: SEASONED LUMBER.		DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2018, CBC 2012, ABC 2019 - PART 9 OF CBC 2012 (2019 AMENDMENT) - CSA 086-09, CSA 086-14 - TPIC 2011, TPIC 2014 (55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL) = L/360 (1.17") CALCULATED VERT. DEFL.(LL) = L/869 (0.21") ALLOWABLE DEFL.(TL) = L/360 (1.17") CALCULATED VERT. DEFL.(TL) = L/989 (0.39") CSK: TC=0.88/1.00 (E-G:1), BC=0.58/1.00 (O-Q:1), WB=0.44/1.00 (B-R:1), SSI=0.26/1.00 (G-H:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 1.00 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (FL) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 786 1987 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.87 (B) (INPUT = 0.90) JSI METAL= 0.74 (P) (INPUT = 1.00)	
PLATES (table in inches) JT TYPE PLATES W LEN Y X B TMVW-p MT20 5.0 6.0 1.75 2.75 C TTWW-m MT20 6.0 9.0 Edge D TMWW-t MT20 4.0 4.0 E TMW-w MT20 2.0 4.0 F TS-t MT20 3.0 6.0 G TMWW-t MT20 4.0 4.0 H TTWW-m MT20 6.0 9.0 Edge I TMVW-p MT20 5.0 6.0 1.75 2.75 K BMV1-p MT20 3.0 4.0 L BMWW-t MT20 4.0 9.0 M BMWW-t MT20 5.0 6.0 N BS-t MT20 4.0 6.0 O BMWWW-t MT20 4.0 9.0 P BS-t MT20 4.0 6.0 Q BMWW-t MT20 5.0 6.0 R BMWW-t MT20 4.0 9.0 S BMV1-p MT20 3.0 4.0 Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.		DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED GROSS REACTION JT VERT 2065 0 S 2065 0 K 2065 0 MAXIMUM FACTORED GROSS REACTION DOWN 2065 0 HORIZ 0 0 UPLIFT 0 0 INPUT BRG IN-SX 5-8 5-8 RECORD BRG IN-SX 5-8 5-8 UNFACTORED REACTIONS 1ST LOOSE MAX/MIN COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL S 1458 970 / 0 0 / 0 0 / 0 488 / 0 0 / 0 K 1458 970 / 0 0 / 0 0 / 0 488 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.97 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS MAX. FACTORED FORCE (LBS) VERT. LOAD LC1 MAX. UNBRACED LENGTH (PL) CSI (LC) FR-TO FROM TO A-B 0 / 35 -91.8 -91.8 0.12 (1) 10.00 R-C -243 / 10 0.09 (1) B-C -2297 / 0 -91.8 -91.8 0.70 (1) 3.78 C-Q 0 / 1989 0.38 (1) C-D -3213 / 0 -91.8 -91.8 0.80 (1) 3.19 Q-D -929 / 0 0.36 (1) D-E -3594 / 0 -91.8 -91.8 0.88 (1) 2.97 D-O 0 / 489 0.11 (1) E-F -3594 / 0 -91.8 -91.8 0.86 (1) 2.97 O-E -505 / 0 0.19 (1) F-G -3594 / 0 -91.8 -91.8 0.86 (1) 2.97 G-H 0 / 490 0.11 (1) G-H -3213 / 0 -91.8 -91.8 0.80 (1) 3.19 H-I -929 / 0 0.36 (1) H-I -2296 / 0 -91.8 -91.8 0.70 (1) 3.78 I-M 0 / 1670 0.38 (1) I-J 0 / 35 -91.8 -91.8 0.12 (1) 10.00 J-L -243 / 10 0.09 (1) S-B -2023 / 0 0.0 0.0 0.21 (1) 5.94 B-R 0 / 1943 0.44 (1) K-L -2023 / 0 0.0 0.0 0.21 (1) 5.94 L-L 0 / 1943 0.44 (1) WEBS MAX. FACTORED FORCE (LBS) VERT. LOAD LC1 MAX. UNBRACED LENGTH (PL) CSI (LC) FR-TO FROM TO S-R 0 / 0 -18.5 -18.5 0.15 (4) 10.00 R-Q 0 / 1904 -18.5 -18.5 0.39 (1) 10.00 Q-P 0 / 3213 -18.5 -18.5 0.58 (1) 10.00 P-O 0 / 3213 -18.5 -18.5 0.58 (1) 10.00 O-N 0 / 3213 -18.5 -18.5 0.58 (1) 10.00 N-M 0 / 3213 -18.5 -18.5 0.58 (1) 10.00 M-L 0 / 1903 -18.5 -18.5 0.39 (1) 10.00 L-K 0 / 0 -18.5 -18.5 0.15 (4) 10.00	




Structural component only
DWG# T-2007147

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T22	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Sat Apr 25 12:49:27 2020 Page 1
ID:K?TPdghj0npl1qYbWIOFzideG-6jO?JbugKnairecCH5ZgyXDemJ?DB9HS2Wpx?7zNBDC

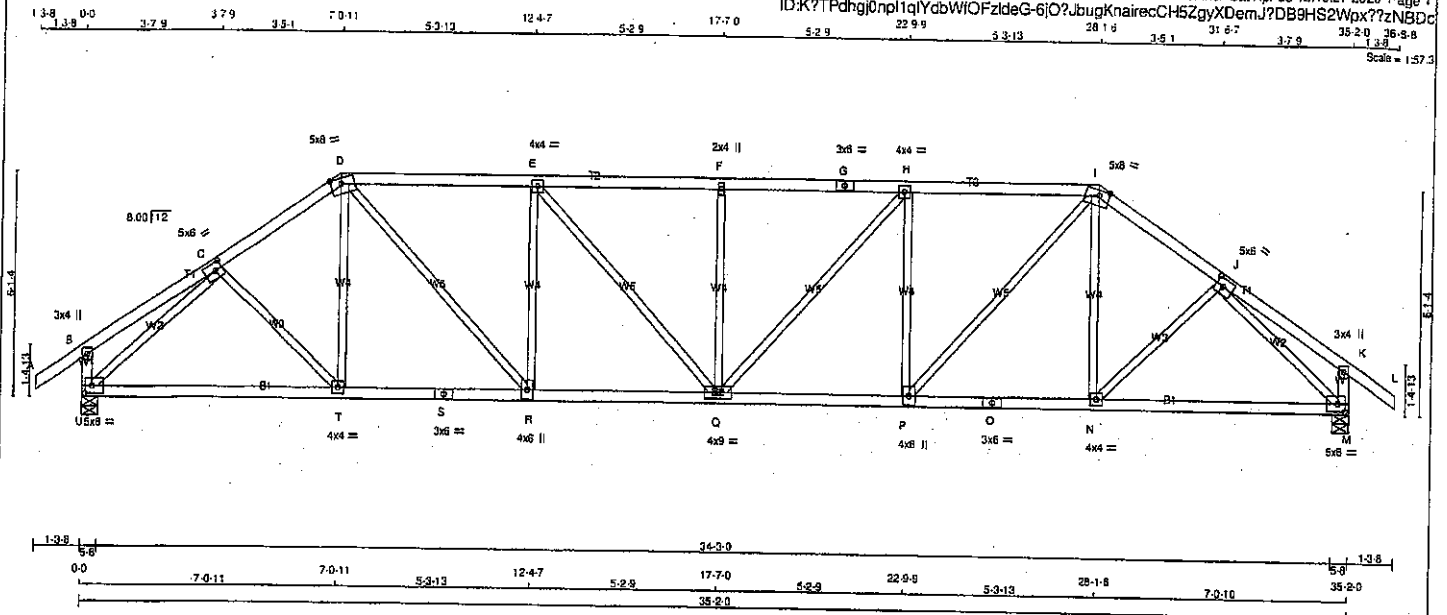

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	LUMBER
A - D	2x4	DRY No.2
D - G	2x4	DRY No.2
G - I	2x4	DRY No.2
I - L	2x4	DRY No.2
U - B	2x4	DRY No.2
M - K	2x4	DRY No.2
U - S	2x4	DRY No.2
S - O	2x4	DRY No.2
O - M	2x4	DRY No.2

ALL WEBS

EXCEPT

DRY; SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMWW-i	MT20	5.0	8.0	2.50	2.50
D TTWW-m	MT20	5.0	8.0	1.75	3.50
E TMWW-i	MT20	4.0	4.0		
F TMWW-w	MT20	2.0	4.0		
G TS-i	MT20	3.0	6.0		
H TMWW-i	MT20	4.0	4.0		
I TTWW-m	MT20	5.0	8.0	1.75	3.50
J TMWW-i	MT20	5.0	8.0	2.50	2.50
K TMV+p	MT20	3.0	4.0		
M BMVW-i	MT20	5.0	8.0	2.50	2.25
N BMWW-i	MT20	4.0	4.0		
O BS-i	MT20	3.0	6.0		
P BMWW-i	MT20	4.0	8.0		
Q BMWW-i	MT20	4.0	8.0		
R BMWW-i	MT20	4.0	8.0		
S BS-i	MT20	3.0	6.0		
T BMWW-i	MT20	4.0	4.0		
U BMVW-i	MT20	5.0	8.0	2.50	2.25

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	0	0
U	HORZ	UPLIFT	0	0
M			5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN COMPONENT REACTIONS	DEAD	SOIL
U	COMBINED	SNOW	0/0	0/0
M		LIVE	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 3.53 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (PLF)	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH
A-B	0/35	-91.8	-91.8	0.12 (1)	10.00	C-T	0/135	0.03 (4)	
B-C	0/18	-91.8	-91.8	0.16 (1)	10.00	T-D	0/90	0.03 (4)	
C-D	-2305/0	-91.8	-91.8	0.23 (1)	4.31	D-R	0/1218	0.27 (1)	
D-E	-2723/0	-91.8	-91.8	0.54 (1)	3.89	R-E	-814/0	0.48 (1)	
E-F	-2966/0	-91.8	-91.8	0.56 (1)	3.53	E-Q	0/363	0.08 (1)	
F-G	-2966/0	-91.8	-91.8	0.56 (1)	3.53	Q-F	-440/0	0.26 (1)	
G-H	-2966/0	-91.8	-91.8	0.56 (1)	3.53	Q-H	0/363	0.08 (1)	
H-I	-2723/0	-91.8	-91.8	0.54 (1)	3.89	P-H	-814/0	0.48 (1)	
I-J	-2305/0	-91.8	-91.8	0.23 (1)	4.31	P-I	0/1218	0.27 (1)	
J-K	0/18	-91.8	-91.8	0.16 (1)	10.00	N-I	0/90	0.03 (4)	
K-L	0/35	-91.8	-91.8	0.12 (1)	10.00	N-J	0/135	0.03 (4)	
U-B	-255/0	0.0	0.0	0.03 (1)	7.81	U-C	-2515/0	0.97 (1)	
M-K	-255/0	0.0	0.0	0.03 (1)	7.81	J-M	-2514/0	0.97 (1)	
U-T	0/1802	-18.5	-18.5	0.40 (1)	10.00				
T-S	0/1901	-18.5	-18.5	0.41 (1)	10.00				
S-R	0/1901	-18.5	-18.5	0.41 (1)	10.00				
R-Q	0/2724	-18.5	-18.5	0.48 (1)	10.00				
Q-P	0/2723	-18.5	-18.5	0.48 (1)	10.00				
P-O	0/1900	-18.5	-18.5	0.41 (1)	10.00				
O-N	0/1900	-18.5	-18.5	0.41 (1)	10.00				
N-M	0/1801	-18.5	-18.5	0.40 (1)	10.00				

TOTAL WEIGHT = 2 X 151 = 303 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/989 (0.16')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/989 (0.29')

CSI: TO=0.55/1.00 (E-F), BC=0.48/1.00 (Q-R), WB=0.97/1.00 (C-U), SSI=0.23/1.00 (H-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN MAX MIN MAX MIN		
MT20	618 354	1667 788 1667 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.90 (M) (INPUT = 0.90)
JSI METAL= 0.63 (C) (INPUT = 1.00)

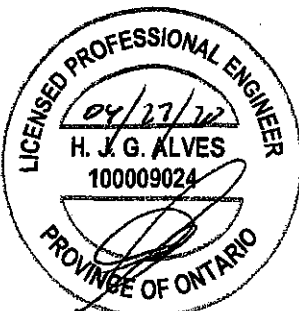

Structural component only
DWG# T-2007148

JOB NAME 408169	TRUSS NAME T23	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:28 2020 Page 1
ID:K?TPdhgJ0np1qYdbWfOFzIdG-bvYNWxv154IZToBQqp4vVknEJLmwjVbHAZVXRzNBDb

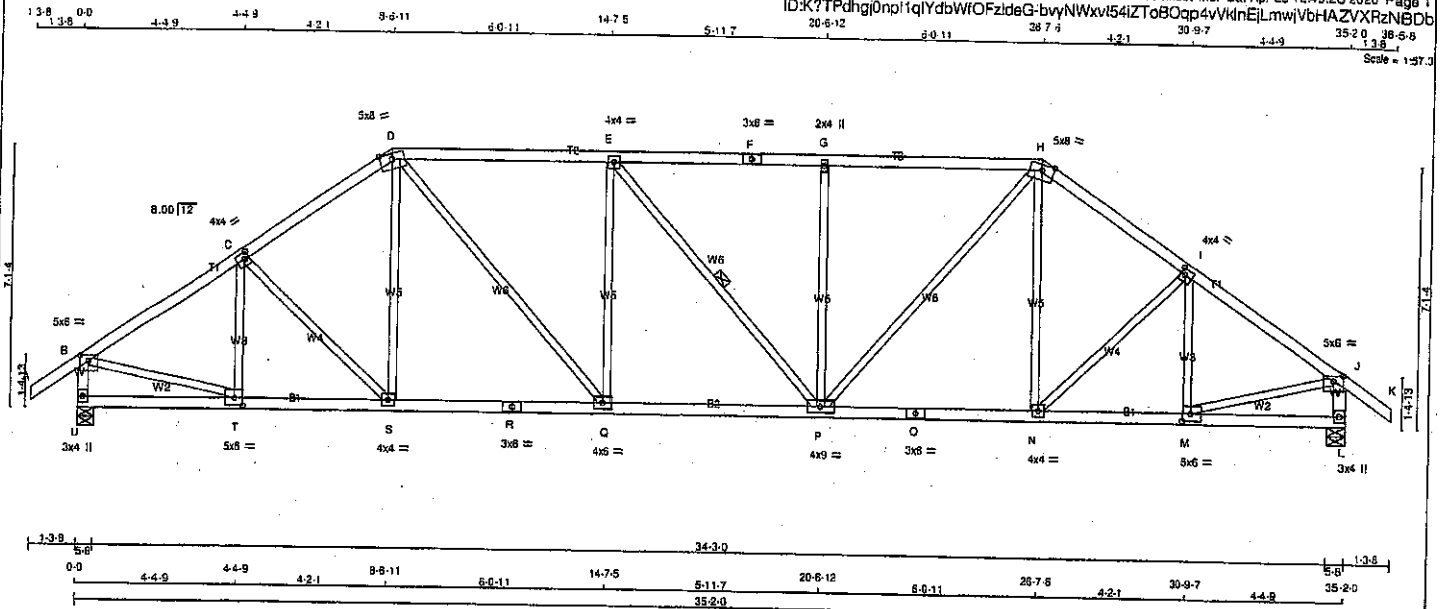

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY-SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	6.0	1.75 2.75
C	TMVW-t	MT20	4.0	4.0	2.00 1.50
D	TTWV-m	MT20	5.0	8.0	Edge
F	TS-1	MT20	4.0	4.0	
F	TS-1	MT20	3.0	6.0	
G	TMVW-w	MT20	2.0	4.0	
H	TTWV-m	MT20	5.0	8.0	Edge
I	TMVW-t	MT20	4.0	4.0	2.00 1.50
J	TMVW-p	MT20	5.0	6.0	1.75 2.75
L	BMV1-p	MT20	3.0	4.0	
M	BMVW-t	MT20	5.0	6.0	2.50 2.75
N	BMVW-t	MT20	5.0	6.0	
O	BS-1	MT20	3.0	6.0	
P	BMVW-t	MT20	4.0	6.0	
Q	BMVW-t	MT20	4.0	6.0	
R	BS-1	MT20	3.0	6.0	
S	BMVW-t	MT20	4.0	4.0	
T	BMVW-t	MT20	5.0	6.0	2.50 2.75
U	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	UP/LIFT	IN-SX
U	2065	0	2065	0	5-8
L	2065	0	2065	0	5-8

UNFACTORED REACTIONS		1ST CASE	MAX/MIN COMPONENT REACTIONS	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
U	1458	970 / 0	0 / 0	0 / 0	488 / 0
L	1458	970 / 0	0 / 0	0 / 0	488 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRACED LENGTH	WEBS	MAX. FACTORED MEMB. FORCE (LBS)	LC1 MAX
FR-TO			FROM TO			FR-TO		
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	T-C	-395 / 0	0.11 (1)
B-C	-2270 / 0	-91.8	-91.8	0.37 (1)	4.19	C-S	-79 / 0	0.05 (1)
C-D	-2254 / 0	-91.8	-91.8	0.38 (1)	4.21	S-D	0 / 156	0.04 (4)
D-E	-2485 / 0	-91.8	-91.8	0.84 (1)	3.72	D-Q	0 / 949	0.21 (1)
E-F	-2483 / 0	-91.8	-91.8	0.84 (1)	3.72	Q-E	-597 / 0	0.52 (1)
F-G	-2483 / 0	-91.8	-91.8	0.84 (1)	3.72	E-P	-2 / 0	0.00 (1)
G-H	-2483 / 0	-91.8	-91.8	0.83 (1)	3.74	P-G	-596 / 0	0.52 (1)
H-I	-2254 / 0	-91.8	-91.8	0.36 (1)	4.21	P-H	0 / 947	0.21 (1)
I-J	-2289 / 0	-91.8	-91.8	0.37 (1)	4.19	H-N	0 / 157	0.04 (4)
J-K	0 / 35	-91.8	-91.8	0.12 (1)	10.00	N-I	-78 / 0	0.05 (1)
U-B	-2027 / 0	0.0	0.0	0.21 (1)	5.94	M-I	-397 / 0	0.11 (1)
L-J	-2028 / 0	0.0	0.0	0.21 (1)	5.94	B-T	0 / 1966	0.44 (1)
						M-J	0 / 1965	0.44 (1)
U-T	0 / 0	-18.5	-18.5	0.08 (4)	10.00			
T-S	0 / 1909	-18.5	-18.5	0.37 (1)	10.00			
S-R	0 / 1854	-18.5	-18.5	0.36 (1)	10.00			
R-Q	0 / 1854	-18.5	-18.5	0.36 (1)	10.00			
Q-P	0 / 2485	-18.5	-18.5	0.47 (1)	10.00			
P-O	0 / 1854	-18.5	-18.5	0.36 (1)	10.00			
O-N	0 / 1854	-18.5	-18.5	0.36 (1)	10.00			
N-M	0 / 1908	-18.5	-18.5	0.37 (1)	10.00			
M-L	0 / 0	-18.5	-18.5	0.08 (4)	10.00			

TOTAL WEIGHT = 2 X 155 = 309 lb

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 38.0 PSF
SPACING	= 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.12')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.24')

CSI: TO=0.64/1.00 (D-E:1), BC=0.47/1.00 (P-Q:1)
WB=0.52/1.00 (E-Q:1), SS=0.26/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES	
PLATE GRIP(DRY)	SHEAR SECTION
(PSI)	(PLI) (PLI)
MAX MIN	MAX MIN
MT20	618 354 1967 798 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (D) (INPUT = 0.90)
JSI METAL= 0.62 (D) (INPUT = 1.00)




Structural component only
DWG# T-2007149

JOB NAME 408169	TRUSS NAME T24	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:29 2020 Page 1
ID:K7TPdhgJ0npH1qYdbWIOFzIdcG-35WmkHwssCqQ4ymbOWc81yIwH7xIBtWqI23uzNBDA

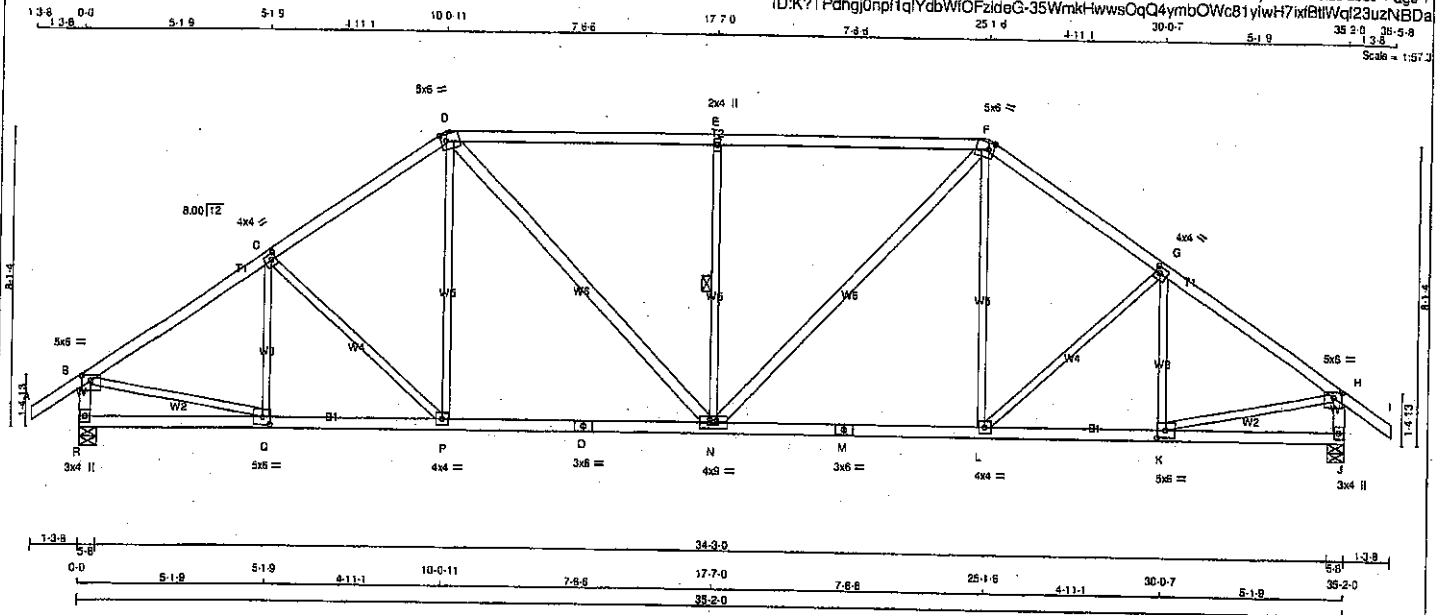

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
I - B	2x4	DRY	No.2	SPF	
B - H	2x4	DRY	No.2	SPF	
H - O	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	
D - N	2x4	DRY	No.2	SPF	
N - F	2x4	DRY	No.2	SPF	

DRY, SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TTWW-m	MT20	5.0	6.0	2.25	1.75
E	TMVW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.25	1.75
G	TMVW-l	MT20	4.0	4.0	2.00	1.50
H	TMVW-p	MT20	5.0	6.0	1.75	2.75
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-t	MT20	5.0	6.0	2.50	2.75
L	BMVW-t	MT20	4.0	4.0		
M	BS-1	MT20	3.0	6.0		
N	BMVW-w	MT20	4.0	9.0		
O	BS-1	MT20	3.0	6.0		
P	BMVW-t	MT20	4.0	4.0		
Q	BMVW-t	MT20	5.0	6.0	2.50	2.75
R	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
R	2085	0	2085	0	5-8	5-8
J	2065	0	2065	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE		MAX/MIN COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
R	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
J	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM	TO	LENGTH	FR-TO		
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	Q-C	-321 / 0 0.11 (1)
B-C	-2318 / 0	-91.8	-91.8	0.38 (1)	4.16	C-P	-218 / 0 0.18 (1)
C-D	-2188 / 0	-91.8	-91.8	0.37 (1)	4.28	P-D	0 / 266 0.08 (1)
D-E	-2274 / 0	-91.8	-91.8	0.81 (1)	3.47	D-N	0 / 891 0.11 (1)
E-F	-2274 / 0	-91.8	-91.8	0.81 (1)	3.47	N-E	-851 / 0 0.35 (1)
F-G	-2185 / 0	-91.8	-91.8	0.37 (1)	4.28	N-F	0 / 891 0.11 (1)
G-H	-2317 / 0	-91.8	-91.8	0.38 (1)	4.16	L-F	0 / 266 0.08 (1)
H-I	0 / 35	-91.8	-91.8	0.12 (1)	10.00	L-G	-218 / 0 0.18 (1)
R-B	-2022 / 0	0.0	0.0	0.21 (1)	5.94	K-G	-321 / 0 0.11 (1)
J-H	-2022 / 0	0.0	0.0	0.21 (1)	5.94	B-Q	0 / 1996 0.45 (1)
					K-H	0 / 1995 0.45 (1)	
R-Q	0 / 0	-18.5	-18.5	0.10 (4)	10.00		
Q-P	0 / 1953	-18.5	-18.5	0.40 (1)	10.00		
P-O	0 / 1794	-18.5	-18.5	0.41 (1)	10.00		
O-N	0 / 1794	-18.5	-18.5	0.41 (1)	10.00		
N-M	0 / 1794	-18.5	-18.5	0.41 (1)	10.00		
M-L	0 / 1794	-18.5	-18.5	0.41 (1)	10.00		
L-K	0 / 1953	-18.5	-18.5	0.40 (1)	10.00		
K-J	0 / 0	-18.5	-18.5	0.10 (4)	10.00		

TOTAL WEIGHT = 2 X 158 = 317 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSK TC=0.81/1.00 (D-E-1), BC=0.41/1.00 (N-P-1),
WB=0.45/1.00 (B-Q-1), SS=0.34/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 789 1987 1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.87 (B) (INPUT = 0.90)
JSI METAL= 0.64 (M) (INPUT = 1.00)

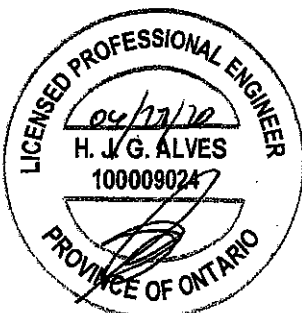

Structural component only
DWG# T-2007150

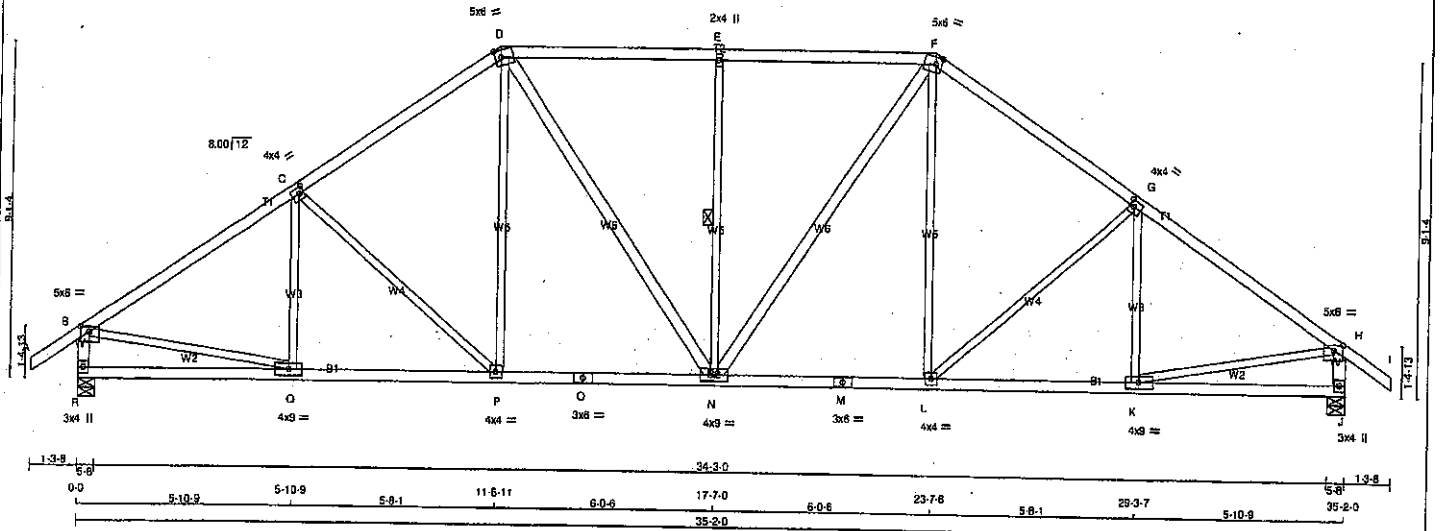

LUMBER
N.L.G.A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - I	2x4	DRY No.2	SPF
R - B	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
R - O	2x4	DRY No.2	SPF
O - M	2x4	DRY No.2	SPF
M - J	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF
D - N	2x4	DRY No.2	SPF
N - F	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	5.0	1.75	2.75
C TMVW-l	MT20	4.0	4.0	2.00	1.50
D TMVW-m	MT20	5.0	6.0	2.25	2.00
E TMVW-w	MT20	2.0	4.0		
F TMVW-m	MT20	5.0	6.0	2.25	2.00
G TMVW-l	MT20	4.0	4.0	2.00	1.50
H TMVW-p	MT20	5.0	6.0	1.75	2.75
J BMV1-p	MT20	3.0	4.0		
K BMVW-l	MT20	4.0	9.0		
L BMVW-l	MT20	4.0	4.0		
M BS-l	MT20	3.0	8.0		
N BMVW-w	MT20	4.0	9.0		
O BS-l	MT20	3.0	6.0		
P BMVW-l	MT20	4.0	4.0		
Q BMVW-l	MT20	4.0	9.0		
R BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	DOWN	BRG	BRG
R 2065	0	5-8	5-8
J 2065	0	5-8	5-8

UNFACTORED REACTIONS

1ST CASE	MAX / MIN	COMPONENT REACTIONS
JT COMBINED	SNOW	LIVE
R 1458	970 / 0	0 / 0
J 1458	970 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8 -91.8	0.12 (1)	Q-C	-248 / 11	0.11 (1)	
B-C	-2347 / 0	-91.8 -91.8	0.52 (1)	C-P	-356 / 0	0.42 (1)	
C-D	-2098 / 0	-91.8 -91.8	0.48 (1)	P-D	0 / 342	0.08 (1)	
D-E	-1985 / 0	-91.8 -91.8	0.49 (1)	D-N	0 / 477	0.08 (1)	
E-F	-1985 / 0	-91.8 -91.8	0.49 (1)	N-E	-877 / 0	0.37 (1)	
F-G	-2095 / 0	-91.8 -91.8	0.48 (1)	N-F	0 / 477	0.08 (1)	
G-H	-2346 / 0	-91.8 -91.8	0.52 (1)	L-F	0 / 341	0.08 (1)	
H-I	0 / 35	-91.8 -91.8	0.12 (1)	L-G	-356 / 0	0.42 (1)	
R-B	-2018 / 0	0.0 0.0	0.21 (1)	K-G	-249 / 11	0.11 (1)	
J-H	-2018 / 0	0.0 0.0	0.21 (1)	B-Q	0 / 2014	0.45 (1)	
				K-H	0 / 2014	0.45 (1)	
R-Q	0 / 0	-18.5 -18.5	0.14 (4)				
Q-P	0 / 1981	-18.5 -18.5	0.39 (1)				
P-O	0 / 1716	-18.5 -18.5	0.34 (1)				
O-N	0 / 1716	-18.5 -18.5	0.34 (1)				
N-M	0 / 1716	-18.5 -18.5	0.34 (1)				
M-L	0 / 1716	-18.5 -18.5	0.34 (1)				
L-K	0 / 1980	-18.5 -18.5	0.39 (1)				
K-J	0 / 0	-18.5 -18.5	0.14 (4)				

TOTAL WEIGHT = 2 X 165 = 329 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.5 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.5 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = L/999 (0.10)
ALLOWABLE DEFL.(TL) = L/360 (1.17)
CALCULATED VERT. DEFL.(TL) = L/999 (0.19)

CSI: TC=0.52/1.00 (B-C:1), BC=0.39/1.00 (P-Q:1), WB=0.45/1.00 (B-Q:1), SS=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (B) (INPUT = 0.90)
JSI METAL= 0.56 (M) (INPUT = 1.00)

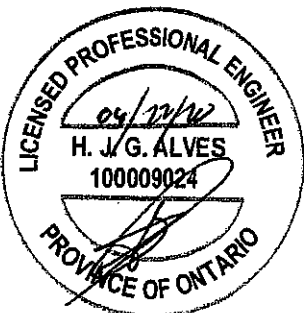

Structural component only
DWG# T-2007151


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408169	T26	5	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:49:32 2020 Page 1

ID:K?TPdHg0nph1qYdbWIOFzIdeG-TpCukMJo9JC?yPVA3e9rlawTUKJTsYXBCoXigDzNBDX

Scale = 1:50.0

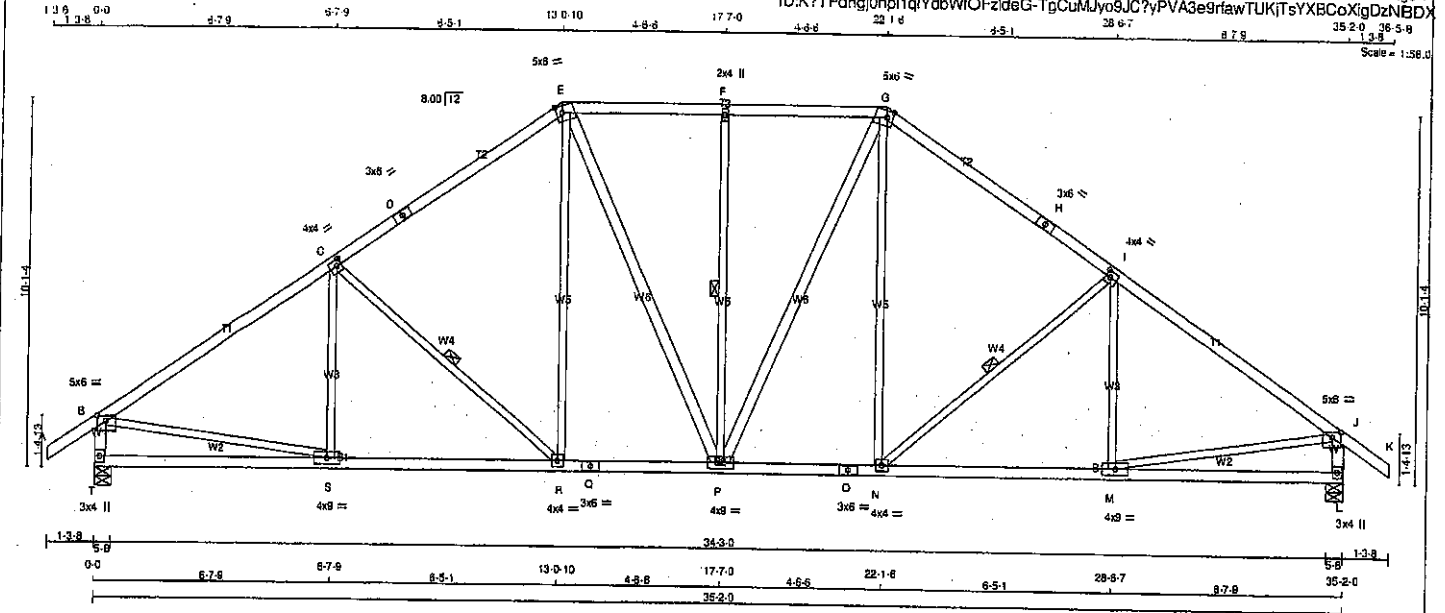

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2			SPF
E - H	2x4	DRY	No.2			SPF
I - K	2x4	DRY	No.2			SPF
L - J	2x4	DRY	No.2			SPF
T - Q	2x4	DRY	No.2			SPF
Q - O	2x4	DRY	No.2			SPF
O - L	2x4	DRY	No.2			SPF
ALL WEBS	2x3	DRY	No.2			SPF
EXCEPT						
E - P	2x4	DRY	No.2			SPF
P - G	2x4	DRY	No.2			SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TS-t	MT20	3.0	5.0		
E	TTWW-m	MT20	5.0	6.0	2.25	2.00
F	TMVW-w	MT20	2.0	4.0		
G	TTWW-m	MT20	5.0	6.0	2.25	2.00
H	TS-t	MT20	3.0	5.0		
I	TMVW-t	MT20	4.0	4.0	2.00	1.50
J	TMVW-p	MT20	5.0	6.0	1.75	2.75
L	BMV1+p	MT20	3.0	4.0		
M	BMVW-t	MT20	4.0	9.0		
N	BMVW-t	MT20	4.0	4.0		
O	BS-t	MT20	3.0	5.0		
P	BMVW-w	MT20	4.0	9.0		
Q	BS-t	MT20	3.0	5.0		
R	BMVW-t	MT20	4.0	4.0		
S	BMVW-t	MT20	4.0	9.0		
T	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORZ	UPLIFT
T	2085	0	0	5-8
L	2085	0	0	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
T	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0
L	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL FITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-R, F-P, H-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED	MAX
MEMB.	FORCE	(PLF)			CS1 (LC)	UNBRAC		FORCE	CS1 (LC)
FR-TO	(LBS)	FROM	TO			LENGTH	FR-TO	(LBS)	
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00		S-C	-189 / 46	0.10 (1)
B-C	-2359 / 0	-91.8	-91.8	0.89 (1)	3.77		C-R	-485 / 0	0.24 (1)
C-D	-1996 / 0	-91.8	-91.8	0.82 (1)	4.11		R-E	0 / 416	0.09 (1)
D-E	-1996 / 0	-91.8	-91.8	0.82 (1)	4.11		E-P	0 / 315	0.05 (1)
E-F	-1761 / 0	-91.8	-91.8	0.27 (1)	4.77		P-F	-502 / 0	0.35 (1)
F-G	-1761 / 0	-91.8	-91.8	0.27 (1)	4.77		P-G	0 / 315	0.05 (1)
G-H	-1996 / 0	-91.8	-91.8	0.62 (1)	4.11		N-G	0 / 415	0.09 (1)
H-I	-1996 / 0	-91.8	-91.8	0.62 (1)	4.11		N-I	-484 / 0	0.24 (1)
I-J	-2359 / 0	-91.8	-91.8	0.89 (1)	3.77		M-I	-189 / 46	0.10 (1)
J-K	0 / 35	-91.8	-91.8	0.12 (1)	10.00		B-S	0 / 2022	0.45 (1)
T-B	-2014 / 0	0.0	0.0	0.21 (1)	5.95		M-J	0 / 2021	0.45 (1)
L-J	-2014 / 0	0.0	0.0	0.21 (1)	5.95				
T-S	0 / 0	-18.5	-18.5	0.19 (4)	10.00				
S-R	0 / 1988	-18.5	-18.5	0.42 (1)	10.00				
R-Q	0 / 1629	-18.5	-18.5	0.32 (1)	10.00				
Q-P	0 / 1629	-18.5	-18.5	0.32 (1)	10.00				
P-O	0 / 1629	-18.5	-18.5	0.32 (1)	10.00				
O-N	0 / 1629	-18.5	-18.5	0.32 (1)	10.00				
N-M	0 / 1985	-18.5	-18.5	0.42 (1)	10.00				
M-L	0 / 0	-18.5	-18.5	0.19 (4)	10.00				

TOTAL WEIGHT = 5 X 172 = 858 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 085-14
- TPIC 2011, TPIC 2014

65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CSI: TC=0.69/1.00 (B-C:1), BC=0.42/1.00 (R-S:1), WB=0.45/1.00 (B-S:1), SSI=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 788 1587 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.87 (B) (INPUT = 0.90)
JSI METAL = 0.50 (O) (INPUT = 1.00)




Structural component only
DWG# T-2007152

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T27	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.316 S.Oct 29 2019 Mtek Industries, Inc. Sat Apr 25 12:49:33 2020 Page 1
ID:K?TPdhg0npl1q/YdbWfOFzIdeG-xlmGzIzRwdKZZ4MdmG4CoSb3k2Cb?nKQSHGfzNBdW

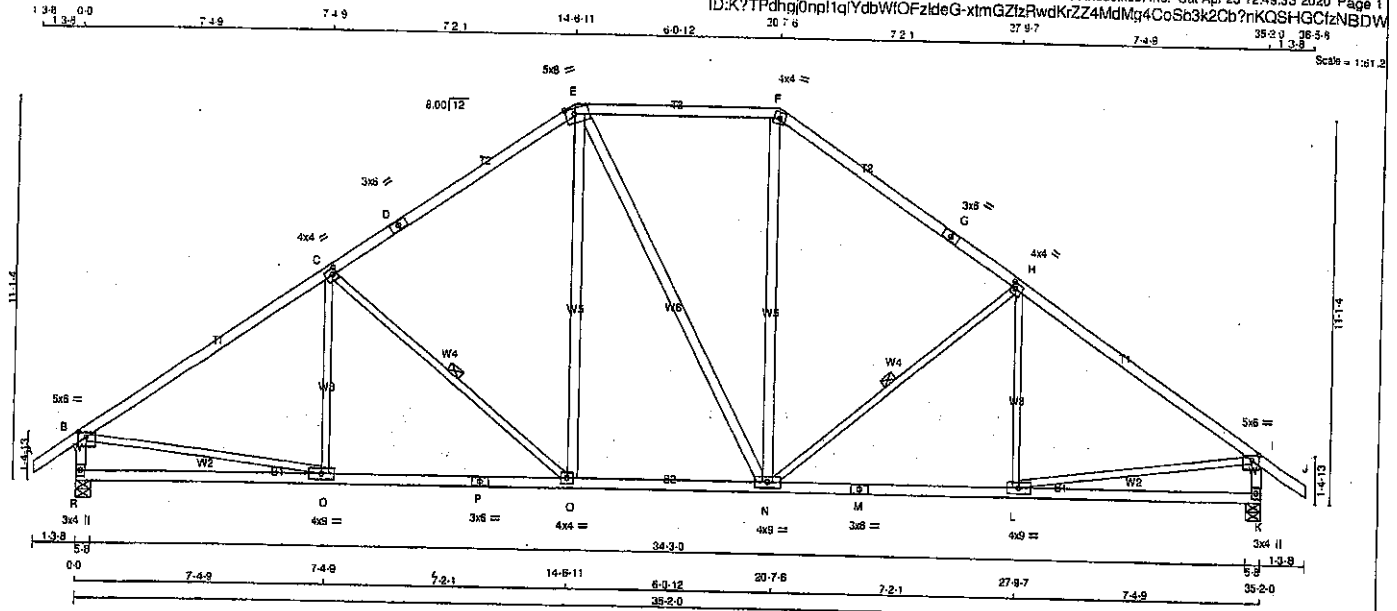

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - E	2x4	DRY No.2	SPF
E - F	2x4	DRY No.2	SPF
F - G	2x4	DRY No.2	SPF
G - J	2x4	DRY No.2	SPF
R - B	2x4	DRY No.2	SPF
K - I	2x4	DRY No.2	SPF
R - P	2x4	DRY No.2	SPF
P - M	2x4	DRY No.2	SPF
M - K	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			
O - E	2x4	DRY No.2	SPF
E - N	2x4	DRY No.2	SPF
N - F	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	6.0	1.75	2.75
C TMVW-t	MT20	4.0	4.0	2.00	1.50
D TS-t	MT20	3.0	6.0		
E TTWW-m	MT20	6.0	8.0	2.00	3.00
F TTW-m	MT20	4.0	4.0		
G TS-t	MT20	3.0	6.0		
H TMVW-t	MT20	4.0	4.0	2.00	1.50
I TMVW-p	MT20	5.0	6.0	1.75	2.75
K BMV1-p	MT20	3.0	4.0		
L BMVW-t	MT20	4.0	9.0		
M BS-t	MT20	3.0	6.0		
N BMVW-t	MT20	4.0	9.0		
O BMVW-t	MT20	4.0	4.0		
P BS-t	MT20	3.0	6.0		
Q BMVW-t	MT20	4.0	9.0		
R BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	2085	0	0	5-8
R	2085	0	0	5-8
K	2085	0	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
K	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.45 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	Q-C	-139 / 76	0.09 (1)
B-C	-2358 / 0	-91.8	-91.8 0.89 (1)	3.45	C-O	-805 / 0	0.38 (1)
C-D	-1888 / 0	-91.8	-91.8 0.78 (1)	3.91	O-E	0 / 499	0.08 (1)
D-E	-1888 / 0	-91.8	-91.8 0.78 (1)	3.91	E-N	0 / 0	0.00 (1)
E-F	-1538 / 0	-91.8	-91.8 0.47 (1)	4.74	N-F	0 / 500	0.08 (1)
F-G	-1888 / 0	-91.8	-91.8 0.78 (1)	3.91	N-H	-604 / 0	0.38 (1)
G-H	-1888 / 0	-91.8	-91.8 0.78 (1)	3.91	H-L	-140 / 75	0.09 (1)
H-I	-2357 / 0	-91.8	-91.8 0.89 (1)	3.45	B-Q	0 / 2020	0.45 (1)
I-J	0 / 35	-91.8	-91.8 0.12 (1)	10.00	L-I	0 / 2019	0.45 (1)
R-B	-2009 / 0	0.0	0.0 0.21 (1)	5.95			
K-I	-2009 / 0	0.0	0.0 0.21 (1)	5.95			
R-Q	0 / 0	-18.5	-18.5 0.25 (4)	10.00			
Q-P	0 / 1999	-18.5	-18.5 0.45 (1)	10.00			
P-O	0 / 1999	-18.5	-18.5 0.45 (1)	10.00			
O-N	0 / 1538	-18.5	-18.5 0.33 (1)	10.00			
N-M	0 / 1998	-18.5	-18.5 0.45 (1)	10.00			
M-L	0 / 1998	-18.5	-18.5 0.45 (1)	10.00			
L-K	0 / 0	-18.5	-18.5 0.24 (4)	10.00			

TOTAL WEIGHT = 2 X 168 = 333 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL = 6.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD = 39.0	PSF	

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.17)
CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CSL: TC=0.89/1.00 (B-C:1), BC=0.45/1.00 (O-Q:1), WB=0.45/1.00 (B-Q:1), SS=0.27/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.90 (F) (INPUT = 0.90)
JSI METAL= 0.88 (P) (INPUT = 1.00)

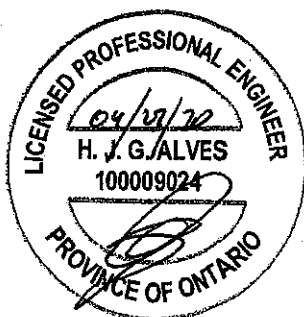

Structural component only
DWG# T-2007153

JOB NAME 408169	TRUSS NAME T28	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:34 2020 Page 1
ID:K7TPdhgJ0npl1qYdbWOFzldG-P3Jfn?_3gwSiBjYB3Bjk??uz8RBKVIUf80p15zNBDV

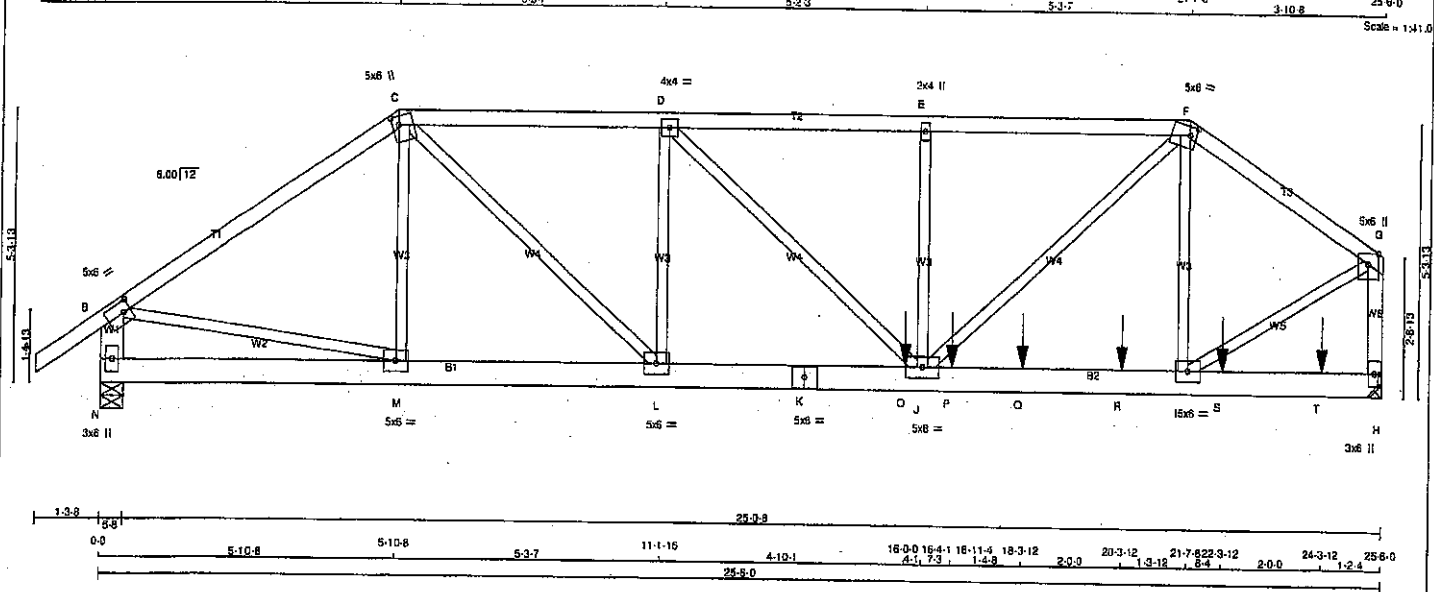

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
N - B	2x6	DRY	No.2
H - G	2x4	DRY	No.2
N - K	2x6	DRY	No.2
K - H	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.
DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
C - F	12	TOP
F - G	12	TOP
H - G	12	TOP
N - B	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
N - K	12	TOP
K - H	12	SIDE (183.1)
WEBS: (0.122"x3") SPIRAL NAILS		
E - J	6	SIDE (77.0)
2x3	1	6

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.
TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.
SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
JT	GROSS REACTION	DOWN	GROSS REACTION	BRG	BRG
N	2086	0	2086	0	5-8
H	2758	0	2758	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL
N	1470 994 / 0 0 / 0 0 / 0 478 / 0 0 / 0
H	1941 1320 / 0 0 / 0 0 / 0 820 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.76 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX. (PLF)	MEMB.	FORCE (LBS)
FR-TO				FR-TO	
A-B	0 / 35	-91.8	-91.8 0.07 (1)	H-C	-218 / 22
B-C	-2363 / 0	-91.8	-91.8 0.37 (1)	C-L	0 / 1550
C-D	-3093 / 0	-91.8	-91.8 0.24 (1)	L-D	-928 / 0
D-E	-3519 / 0	-91.8	-91.8 0.25 (1)	D-J	0 / 599
E-F	-3519 / 0	-91.8	-91.8 0.24 (1)	J-E	-508 / 0
F-G	-2352 / 0	-91.8	-91.8 0.16 (1)	J-F	0 / 2156
N-B	-2037 / 0	0.0	0.0 0.07 (1)	J-F	-548 / 0
H-G	-2632 / 0	0.0	0.0 0.19 (1)	B-M	0 / 1991
				I-G	0 / 2264
N-M	0 / 0	-18.5	-18.5 0.04 (4)		
M-L	0 / 1959	-18.5	-18.5 0.14 (1)		
L-K	0 / 3093	-18.5	-18.5 0.27 (1)		
K-O	0 / 3093	-18.5	-18.5 0.27 (1)		
O-J	0 / 3093	-18.5	-18.5 0.27 (1)		
J-P	0 / 1942	-18.5	-18.5 0.23 (1)		
P-Q	0 / 1942	-18.5	-18.5 0.23 (1)		
Q-R	0 / 1942	-18.5	-18.5 0.23 (1)		
R-I	0 / 1942	-18.5	-18.5 0.23 (1)		
I-S	0 / 0	-18.5	-18.5 0.10 (1)		
S-T	0 / 0	-18.5	-18.5 0.10 (1)		
T-H	0 / 0	-18.5	-18.5 0.10 (1)		

FACTORED CONCENTRATED LOADS (LBS)		LOC.	LG1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
JT										
O	16-0-0	-997	-997	---	---	FRONT	VERT	TOTAL	---	C1
P	16-11-4	-187	-187	---	---	FRONT	VERT	TOTAL	---	C1
Q	18-3-12	-187	-187	---	---	FRONT	VERT	TOTAL	---	C1
R	20-3-12	-187	-187	---	---	FRONT	VERT	TOTAL	---	C1
S	22-3-12	-174	-174	---	---	FRONT	VERT	TOTAL	---	C1
T	24-3-12	-173	-173	---	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 122 = 245 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCS 2010, NBCS 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCS 2010, NBCS 2012, ABC 2019
- PART 9 OF NBCS 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.85")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (0.85")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CS: TC=0.37/1.00 (B-C:1), GC=0.27/1.00 (J-L:1), WB=0.28/1.00 (G-I:1), SS=0.34/1.00 (J-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1667 788 1987 1668

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.90 (F) (INPUT = 0.90)
JSI METAL= 0.45 (G) (INPUT = 1.00)

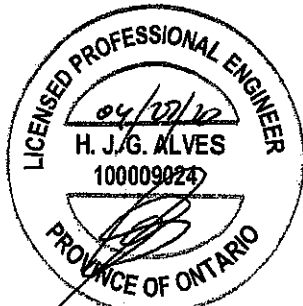

Structural component only
DWG# T-2007154 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T28	1	2	GREEN PARK HOMES	


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:34 2020 Page 2
ID:K?TPdHg0npl1qYdbWfOFzdeG-P3Jm?_3gwSiBifYB3BJk??uz8RBKVIUf60p5zNBdV


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	6.0	2.50	1.75
C	TTWW+m	MT20	5.0	6.0	2.00	1.50
D	TMVW-t	MT20	4.0	4.0		
E	TMVW+w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.00	1.50
G	TMVW+p	MT20	5.0	6.0	Edge	
H	BMV1+p	MT20	3.0	6.0		
I, L, M						
I	BMVW-t	MT20	5.0	6.0		
J	BMVWW-t	MT20	5.0	8.0		
K	BS-t	MT20	5.0	8.0		
N	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

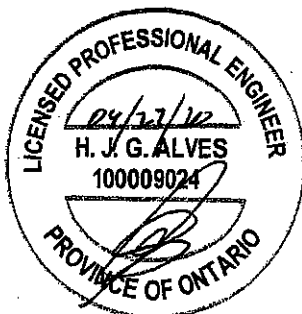

Structural component only
DWG# T-2007154 *JK*

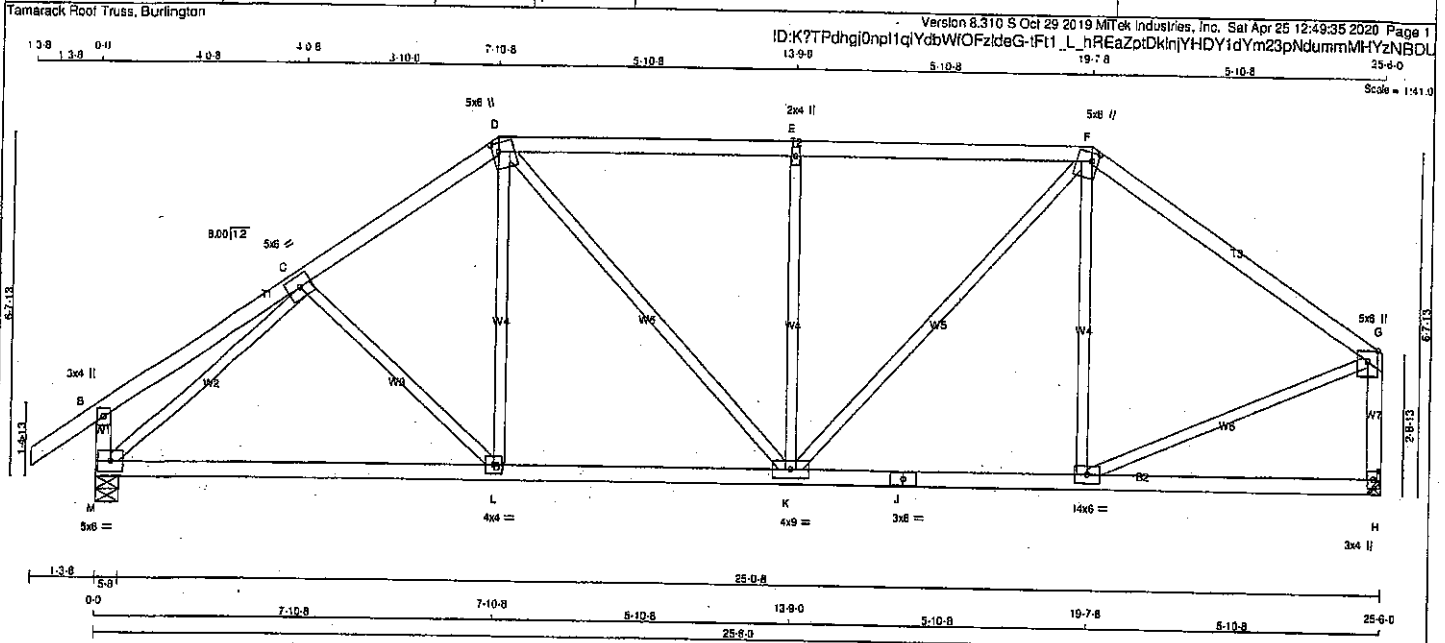

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
M - B	2x4	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWV-t	MT20	5.0	6.0		
D	TTWV+m	MT20	5.0	6.0	2.00	1.50
E	TMW+w	MT20	2.0	4.0		
F	TTWV+m	MT20	5.0	6.0	2.00	1.50
G	TMWV+p	MT20	5.0	6.0	Edge	
H	BMV1+p	MT20	3.0	4.0		
I	BMWV-t	MT20	4.0	6.0		
J	BS-t	MT20	3.0	6.0		
K	BMWVW-t	MT20	4.0	6.0		
L	BMWV-t	MT20	4.0	6.0		
M	BMWV-t	MT20	5.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	DOWN	IN-SX	IN-SX
M 1532	0	5-8	5-8
H 1408	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS
M	1081	723 / 0	0 / 0
H	994	652 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.89 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL FITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	C-L	-80 / 27	0.04 (1)	
S-C	0 / 22	-91.8	-91.8 0.22 (1)	L-D	0 / 209	0.05 (4)	
C-D	-1491 / 0	-91.8	-91.8 0.19 (1)	D-K	0 / 364	0.08 (1)	
D-E	-1494 / 0	-91.8	-91.8 0.44 (1)	K-E	-662 / 0	0.46 (1)	
E-F	-1484 / 0	-91.8	-91.8 0.44 (1)	K-F	0 / 663	0.15 (1)	
F-G	-1228 / 0	-91.8	-91.8 0.44 (1)	I-F	-282 / 0	0.21 (1)	
M-B	-265 / 0	0.0	0.03 (1)	M-C	-1757 / 0	0.83 (1)	
H-G	-1362 / 0	0.0	0.0 0.20 (1)	I-G	0 / 1098	0.25 (1)	
M-L	0 / 1279	-18.5	-18.5 0.36 (4)				
L-K	0 / 1223	-18.5	-18.5 0.36 (4)				
K-J	0 / 1014	-18.5	-18.5 0.25 (1)				
J-I	0 / 1014	-18.5	-18.5 0.25 (1)				
I-H	0 / 0	-18.5	-18.5 0.17 (4)				

TOTAL WEIGHT = 109 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.85")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.85")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CSI: TC=0.44/1.00 (F-G-1), RC=0.38/1.00 (K-L-4),
WB=0.83/1.00 (C-M-1), SS=0.26/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1997 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP=0.82 (D) (INPUT = 0.90)
JSI METAL=0.51 (G) (INPUT = 1.00)

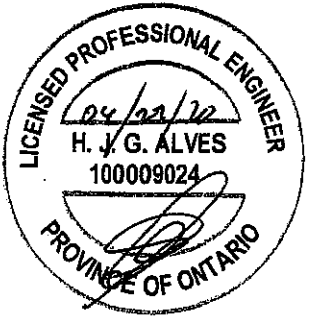

Structural component only
DWG# T-2007155

JOB NAME 408169	TRUSS NAME T30	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:36 2020 Page 1
ID:K?TPdhgJ0np1tqYdbWIOFzIdeG-MSRPCg?JCYIQ1oxIUEnpQ4FSy9zoKvN7QVwp_zNBDT

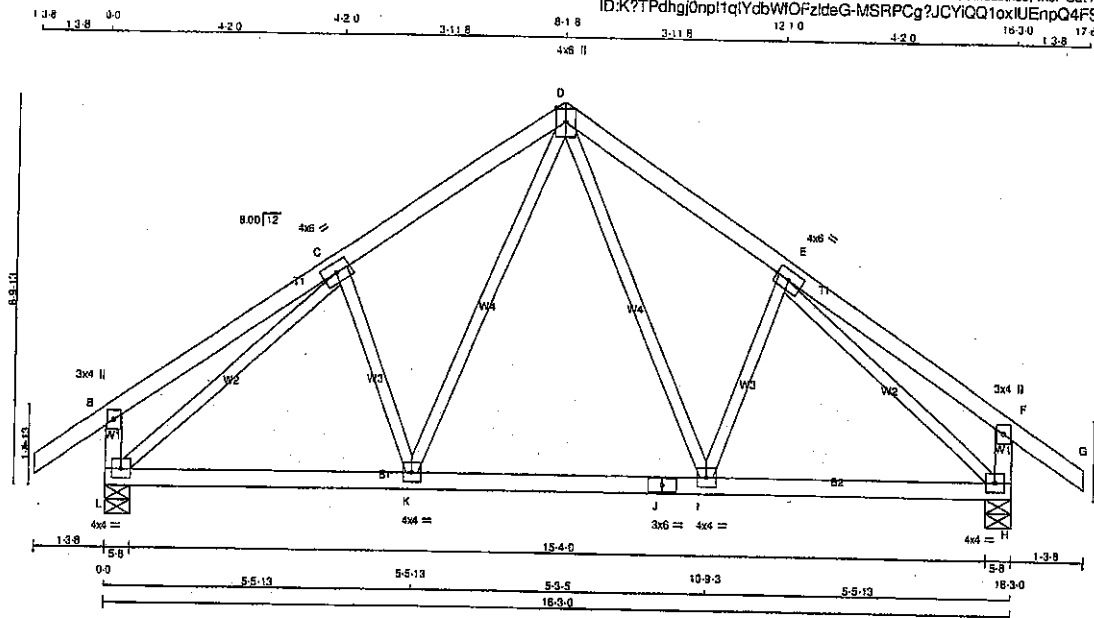

Scale = 1/2" = 1'-0"

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	LUMBER
A - D	2x4	DRY No.2
D - G	2x4	DRY No.2
L - B	2x4	DRY No.2
H - F	2x4	DRY No.2
L - J	2x4	DRY No.2
J - H	2x4	DRY No.2

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (tablets/inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMWW-t	MT20	4.0	6.0		
D TTWW+p	MT20	4.0	6.0		Edge
E TMWW-t	MT20	4.0	6.0		
F TMV+p	MT20	3.0	4.0		
H BMVW-t	MT20	4.0	4.0		
I BMVW-t	MT20	4.0	4.0		
J BS-t	MT20	3.0	6.0		
K BMVW-t	MT20	4.0	4.0		
L BMVW-t	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	UP/LIFT		
L	1022	0	1022	0	5-8	5-8
H	1022	0	1022	0	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	720	486 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0
H	720	486 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	UNBRAC LENGTH
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	D-I	0 / 338	0.08 (1)	10.00
B-C	0 / 24	-91.8	-91.8 0.24 (1)	E-E	-217 / 0	0.06 (1)	10.00
C-D	-845 / 0	-91.8	-91.8 0.19 (1)	K-D	0 / 336	0.09 (1)	6.25
D-E	-845 / 0	-91.8	-91.8 0.19 (1)	C-K	-217 / 0	0.06 (1)	6.25
E-F	0 / 24	-91.8	-91.8 0.24 (1)	L-C	-1042 / 0	0.52 (1)	10.00
F-G	0 / 35	-91.8	-91.8 0.12 (1)	E-H	-1042 / 0	0.52 (1)	10.00
L-B	-268 / 0	0.0	0.0 0.03 (1)				7.81
H-F	-268 / 0	0.0	0.0 0.03 (1)				7.81
L-K	0 / 782	-18.5	-18.5 0.19 (1)				10.00
K-J	0 / 557	-18.5	-18.5 0.17 (4)				10.00
J-I	0 / 557	-18.5	-18.5 0.17 (4)				10.00
I-H	0 / 782	-18.5	-18.5 0.19 (1)				10.00

TOTAL WEIGHT = 2 X 72 = 145 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

OSI: TC=0.24/1.00 (B-C:1), BC=0.19/1.00 (H-I:1), WB=0.52/1.00 (C-L:1), SSI=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10


COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (FL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 758 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (H) (INPUT = 0.80)
JSI METAL = 0.29 (L) (INPUT = 1.00)

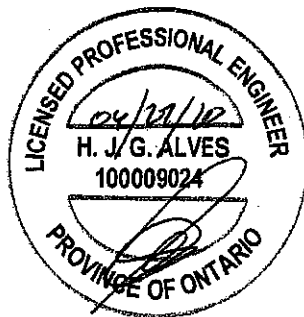


Structural component only
DWG# T-2007156

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408169	T30A	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:37 2020 Page 1

ID:K?TPahgi0npl1qIYdbWfOFZdeG-qe?nP00xzcH2AN7sC0MedQCLVGXc_wL4FTLQzNBDS

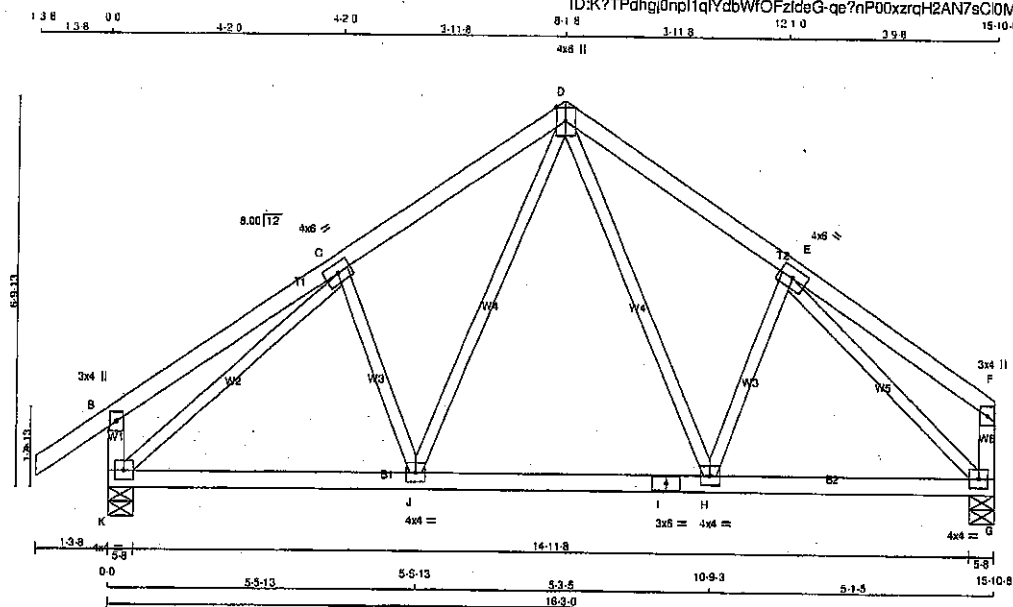

Scale = 1/32"

LUMBER

N. L. G. A. RULES	SIZE	LUMBER
CHORDS		
A - D	2x4	DRY
D - F	2x4	DRY
K - B	2x4	DRY
G - F	2x4	DRY
K - I	2x4	DRY
I - G	2x4	DRY

ALL WEBS 2x3 DRY No.2
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMWW-t	MT20	4.0	6.0		
D TTWW+p	MT20	4.0	6.0	Edge	
E TMWW-t	MT20	4.0	6.0		
F TMV+p	MT20	3.0	4.0		
G BMVW1-t	MT20	4.0	4.0		
H BMWW-t	MT20	4.0	4.0		
I BS-t	MT20	3.0	6.0		
J BMWW-t	MT20	4.0	4.0		
K BMVW1-t	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
K	1001	0	1001	0
G	875	0	875	0

UNFACTORED REACTIONS

	1ST CASE	MAX./MIN. COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
K	705	478 / 0	0 / 0	0 / 0	0 / 0	229 / 0
G	619	408 / 0	0 / 0	0 / 0	0 / 0	213 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 35	-91.8	-91.8	0.12 (1)	D-H	0 / 272	0.06 (1)
B-C	0 / 24	-91.8	-91.8	0.24 (1)	H-E	-160 / 2	0.05 (1)
C-D	-817 / 0	-91.8	-91.8	0.19 (1)	J-D	0 / 342	0.08 (1)
D-E	-793 / 0	-91.8	-91.8	0.18 (1)	C-J	-222 / 0	0.06 (1)
E-F	0 / 24	-91.8	-91.8	0.22 (1)	K-C	-1012 / 0	0.51 (1)
K-B	-268 / 0	0.0	0.0	0.03 (1)	E-G	-992 / 0	0.44 (1)
G-F	-124 / 0	0.0	0.0	0.01 (1)			
K-J	0 / 740	-18.5	-18.5	0.18 (1)			
J-I	0 / 531	-18.5	-18.5	0.17 (4)			
I-H	0 / 531	-18.5	-18.5	0.17 (4)			
H-G	0 / 691	-18.5	-18.5	0.17 (1)			

TOTAL WEIGHT = 2 X 70 = 140 lb

(M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/960$ (0.53")
CALCULATED VERT. DEFL.(LL) = $L/998$ (0.02")
ALLOWABLE DEFL.(TL) = $L/960$ (0.53")
CALCULATED VERT. DEFL.(TL) = $L/969$ (0.04")

CSI: TC=0.24/1.00 (B-C:1), BC=0.18/1.00 (J-K:1), WB=0.51/1.00 (C-K:1), SSI=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (K) (INPUT = 0.90)
JSI METAL= 0.28 (K) (INPUT = 1.00)




Structural component only
DWG# T-2007157

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408169	T30S	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:38 2020 Page 1
ID:K?TPdngj0npl1qYdbWICFzldcG-lqZ9cm1ZK9y8gKyJQvGFvAbEImYGAW4ak_1uszNBDR

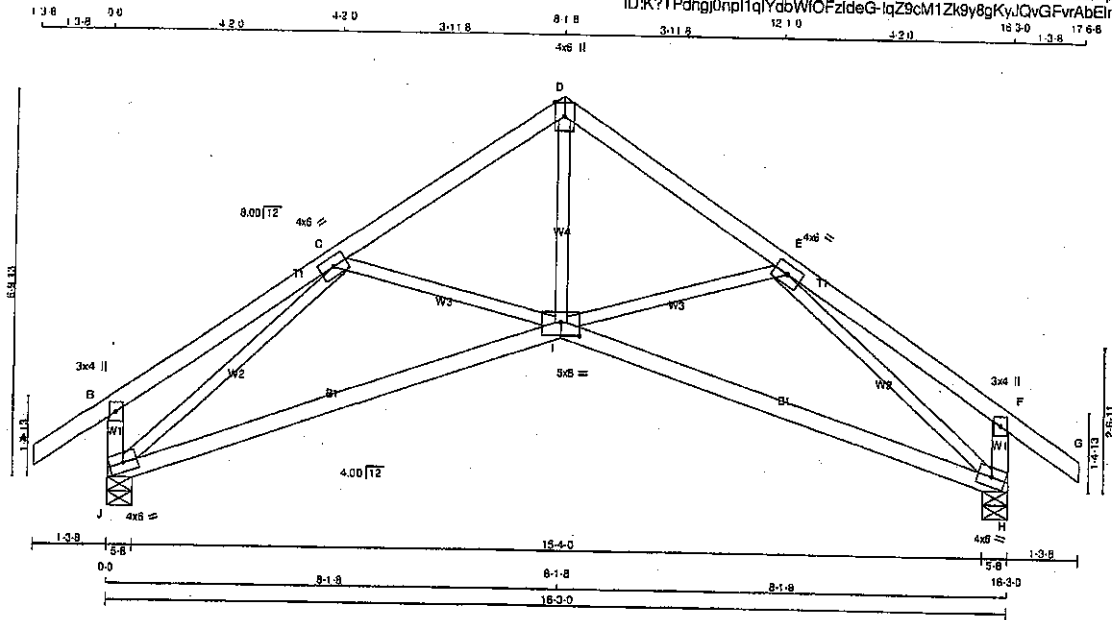

Scale = 1:37.5

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No. 2
D - G	2x4	DRY	No. 2
J - S	2x4	DRY	No. 2
H - F	2x4	DRY	No. 2
J - I	2x4	DRY	No. 2
I - H	2x4	DRY	No. 2

ALL WEBS 2x3 DRY No. 2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMWW-t	MT20	4.0	6.0		
D TTW+p	MT20	4.0	6.0	Edge	
E TMWW-t	MT20	4.0	6.0		
F TMV+p	MT20	3.0	4.0		
H BMVW1-t	MT20	4.0	6.0		
I BMVW1-t	MT20	5.0	8.0	2.75	4.00
J BMVW1-t	MT20	4.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
J	1022	0	1022	0	5-8	5-8
H	1022	0	1022	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LOASE COMBINED		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM. LIVE	WIND			
J	720	488 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0
H	720	488 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0

SEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.76 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8 -91.8	0.12 (1)	I-D	0 / 942	0.21 (1)	
B-C	0 / 22	-91.8 -91.8	0.22 (1)	I-E	-143 / 11	0.05 (1)	
C-D	-1134 / 0	-91.8 -91.8	0.19 (1)	C-I	-143 / 11	0.05 (1)	
D-E	-1134 / 0	-91.8 -91.8	0.19 (1)	J-C	-1478 / 0	0.78 (1)	
E-F	0 / 22	-91.8 -91.8	0.22 (1)	E-H	-1478 / 0	0.78 (1)	
F-G	0 / 35	-91.8 -91.8	0.12 (1)				
J-B	-273 / 0	0.0 0.0	0.08 (1)				
H-F	-273 / 0	0.0 0.0	0.08 (1)				
J-I	0 / 1120	-18.5 -18.5	0.44 (4)				
I-H	0 / 1120	-18.5 -18.5	0.44 (4)				

TOTAL WEIGHT = 2 X 57 = 133 lb

(M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/899 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/769 (0.25")

CSI: TC=0.22/1.00 (E-F:1), BC=0.44/1.00 (H-I:4),
WB=0.78/1.00 (C-I:1), SS=0.15/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PS)	(PL)	(FL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1937 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (H) (INPUT = 0.50)
JSI METAL= 0.35 (H) (INPUT = 1.00)



Structural component only
DWG# T-2007158


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408169	T31S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

ID:K7TFdhgJ0np1qVdbWfOFzdeG-m17Yqj1BVT47HUXW_dnUR3inH9Cs?pxDpOkaQJzNBDC

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:39 2020 Page 1

Scale = 1/28.8

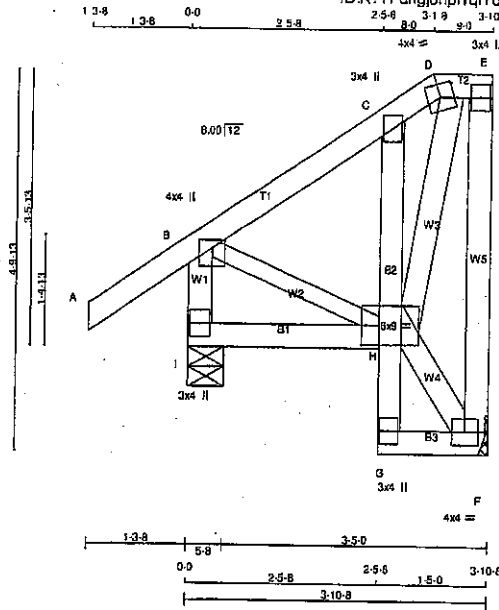

LUMBER

N.L.G.A. RULES

CHORDS SIZE

A - D 2x4 DRY LUMBER

D - E 2x4 DRY LUMBER

F - E 2x4 DRY LUMBER

I - B 2x4 DRY LUMBER

I - H 2x4 DRY LUMBER

G - C 2x4 DRY LUMBER

G - F 2x4 DRY LUMBER

ALL WEBS 2x4 DRY LUMBER

EXCEPT

B - H 2x3 DRY LUMBER

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	193	0	193	0
I	361	0	361	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

	1ST CASE	MAX/MIN	COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	136	88 / 0	0 / 0	0 / 0	0 / 0	49 / 0	0 / 0
I	252	181 / 0	0 / 0	0 / 0	0 / 0	72 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH FR-TO	FR-TO			
A-B	0 / 35	-91.8 -91.8	0.14 (5)	10.00	H-F	-27 / 0	0.00 (1)
B-C	-87 / 0	-91.8 -91.8	0.09 (1)	6.25	B-H	0 / 68	0.02 (1)
C-D	-99 / 0	-91.8 -91.8	0.07 (1)	6.25	H-D	0 / 173	0.03 (1)
D-E	-11 / 0	-91.8 -91.8	0.07 (1)	6.25			
F-E	-148 / 0	0.0 0.0	0.04 (1)	7.81			
I-B	-327 / 0	0.0 0.0	0.02 (4)	7.81			
I-H	0 / 8	-18.5 -18.5	0.03 (4)	10.00			
G-H	-2 / 8	0.0 0.0	0.05 (1)	10.00			
H-C	-203 / 0	0.0 0.0	0.04 (1)	7.81			
G-F	0 / 30	-18.5 -18.5	0.03 (1)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 29 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
DL =	6.0	PSF
BOT CH.	LL = 0.0	PSF
DL =	7.4	PSF
TOTAL LOAD =	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.01")

CSI: TC=0.14/1.00 (A-B-5); BC=0.05/1.00 (G-H-1); WB=0.03/1.00 (D-H-1); SS=0.12/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.23 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)

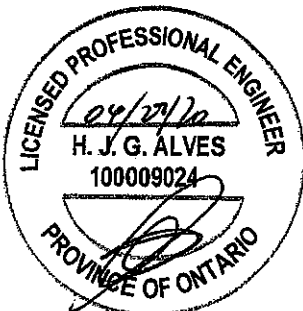


Structural component only
DWG# T-2007159

JOB NAME 408169	TRUSS NAME T32S	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:48:40 2020 Page 1
ID:K7TPchqjDnpl1qYdbWfOFzldG-EDhw122qGmCsve6iXKjL_GFy1ZYDkG4M22T7ylzNBDF

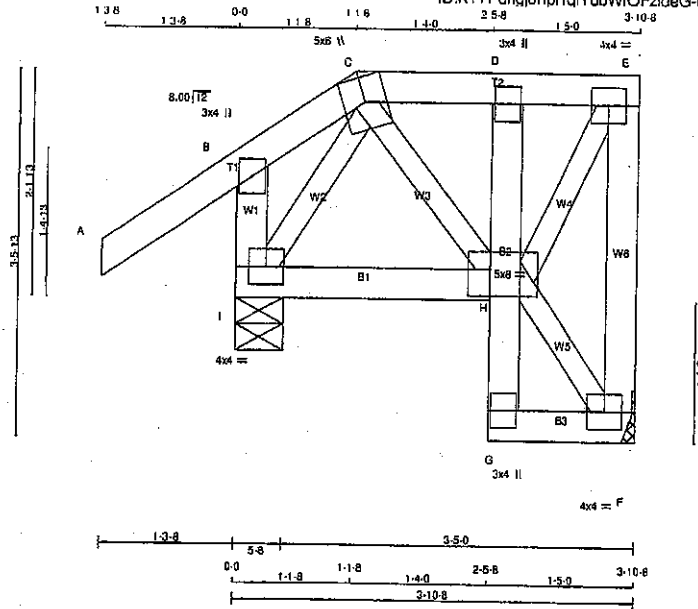

Scale = 1:20.1

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
I - J	2x4	DRY	No.2	SPF	
K - L	2x4	DRY	No.2	SPF	
M - N	2x4	DRY	No.2	SPF	
O - P	2x4	DRY	No.2	SPF	
Q - R	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TTWW+m	MT20	5.0	6.0	Edge	
D	TMV+p	MT20	3.0	4.0		
E	TMVW-i	MT20	4.0	4.0		
F	BMVW-i	MT20	4.0	4.0		
G	BMV+p	MT20	3.0	4.0		
H	BMVWVW-i	MT20	5.0	8.0	3.00	2.50
I	BMVW-i	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
F	191	0	191	0	0	MECHANICAL	
I	362	0	362	0	0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LOASE		MAX/MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	136	87 / -12	0 / 0	0 / 0	0 / 0	49 / 0	0 / 0
I	253	192 / 0	0 / 0	0 / 0	0 / 0	71 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSF (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSF (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8 -91.8 0.14 (5)	10.00	C-H	0 / 60	0.01 (1)	
B-C	-41 / 0	-91.8 -91.8 0.13 (5)	6.25	H-F	-7 / 0	0.03 (1)	
C-D	-89 / 0	-91.8 -91.8 0.02 (1)	8.25	H-E	0 / 153	0.03 (1)	
D-E	-85 / 0	-91.8 -91.8 0.02 (1)	6.25	I-C	-100 / 34	0.02 (1)	
E-F	-175 / 0	0.0 0.0 0.03 (1)	7.81				
I-B	-253 / 0	0.0 0.0 0.03 (1)	7.81				
I-H	-18 / 53	-18.5 -18.5 0.04 (4)	8.25				
G-H	0 / 13	0.0 0.0 0.01 (1)	10.00				
H-D	-142 / 0	0.0 0.0 0.01 (1)	7.81				
G-F	0 / 5	-18.5 -18.5 0.01 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 25 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSF: TC=0.14/1.00 (A-B:5), BC=0.04/1.00 (H-I:4), WB=0.03/1.00 (E-H:1), SS=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PL)	(PL)
	MAX	MIN	MAX MIN
MT20	618	354	1687 798 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (E) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007160


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T33	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitex Industries, Inc. Sat Apr 25 12:49:41 2020 Page 1

ID:K?TPdghj0npl1qlydbWlOfZdeG-IPFIFO3S14LXohu51pyWUo8MznVTgTWGidhUBzNBDC

Scale = 1/23.3

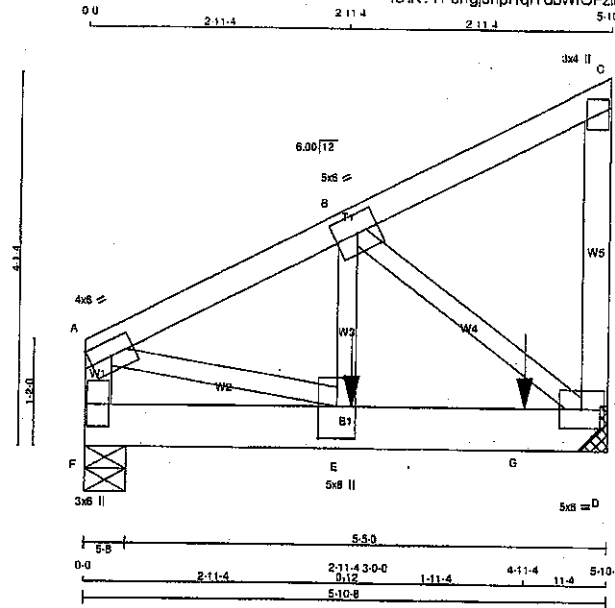

LUMBER

N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F-A	2x4	DRY	No.2	SPF
A-C	2x4	DRY	No.2	SPF
D-C	2x4	DRY	No.2	SPF
F-D	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
F-A	12	TOP
A-C	12	TOP
C-D	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
F-D	9	SIDE(305.2)
WEBS: (0.122"x3") SPIRAL NAILS		
B-E	2	SIDE(408.9)
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	4.0	6.0		Edge
B	TMVW-1	MT20	5.0	6.0		
C	TMVW-1	MT20	3.0	4.0		
D	BMVW-1	MT20	5.0	6.0		
E	BMVW-1	MT20	5.0	8.0	4.25	2.50

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	UPLIFT
F	1914	0	0
D	2859	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW
F	1348	915 / 0
D	2015	1359 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.59 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		FACTORED	
MEMB.	FORCE	VERT. LOAD	LC1 MAX	MEMB.	FORCE	MAX	
	(LBS)	(PLF)	CSI (LC)		(LBS)	CSI (LC)	
FR-TO		FROM TO		FR-TO			
F-A	-1877 / 0	0.0	0.0 0.10 (†)	A-E	0 / 2380	0.29 (†)	
A-B	-2568 / 0	-91.8	-91.8 0.08 (†)	E-B	0 / 2608	0.32 (†)	
B-C	-7 / 0	-91.8	-91.8 0.06 (†)	B-D	-2898 / 0	0.35 (†)	
D-C	-120 / 0	0.0	0.0 0.01 (†)				
F-E	0 / 0	-18.5	-18.5 0.01 (†)	10.00			
E-G	0 / 2301	-18.5	-18.5 0.49 (†)	10.00			
G-D	0 / 2301	-18.5	-18.5 0.49 (†)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC	LC1	MAX	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	3-0-0	-2737	-2737	---	BACK	VERT	TOTAL	---	C1
G	4-11-4	-1388	-1388	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 29 = 58 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL = 6.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD	= 36.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CS1: TC=0.10/1.00 (A-F:1), BC=0.49/1.00 (D-E:1), WB=0.35/1.00 (B-D:1), SS=0.33/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1867
	788	1987	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.84 (B) (INPUT = 0.80)
JSI METAL = 0.44 (E) (INPUT = 1.00)

CONTINUED ON PAGE 2

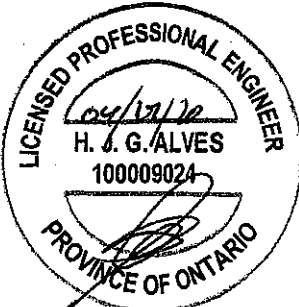

Structural component only
DWG# T-2007161 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408169	T33	1	2	TRUSS DESC.		


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:41 2020 Page 2
ID:K?TPdngl0npl1qYdbWlOFzideG-IPFI03S14LIXohu51pyWUoBMznVTgTWGIDhUBzNBDO

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
F	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

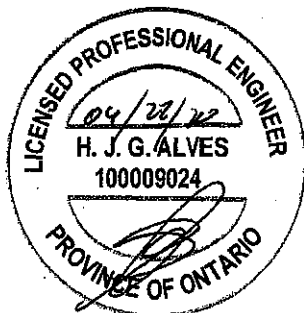


Structural component only
DWG# T-2007161 42

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T40	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:15 2020 Page 1
ID:K?TPdghi0np1qYdbWfOfZldeG-dToLVCBPTkKk_gKpGOLn4U0ubv6N8dVf?sayUzNB1c
35-2 35-8 35-3
Scale = 1:57.3

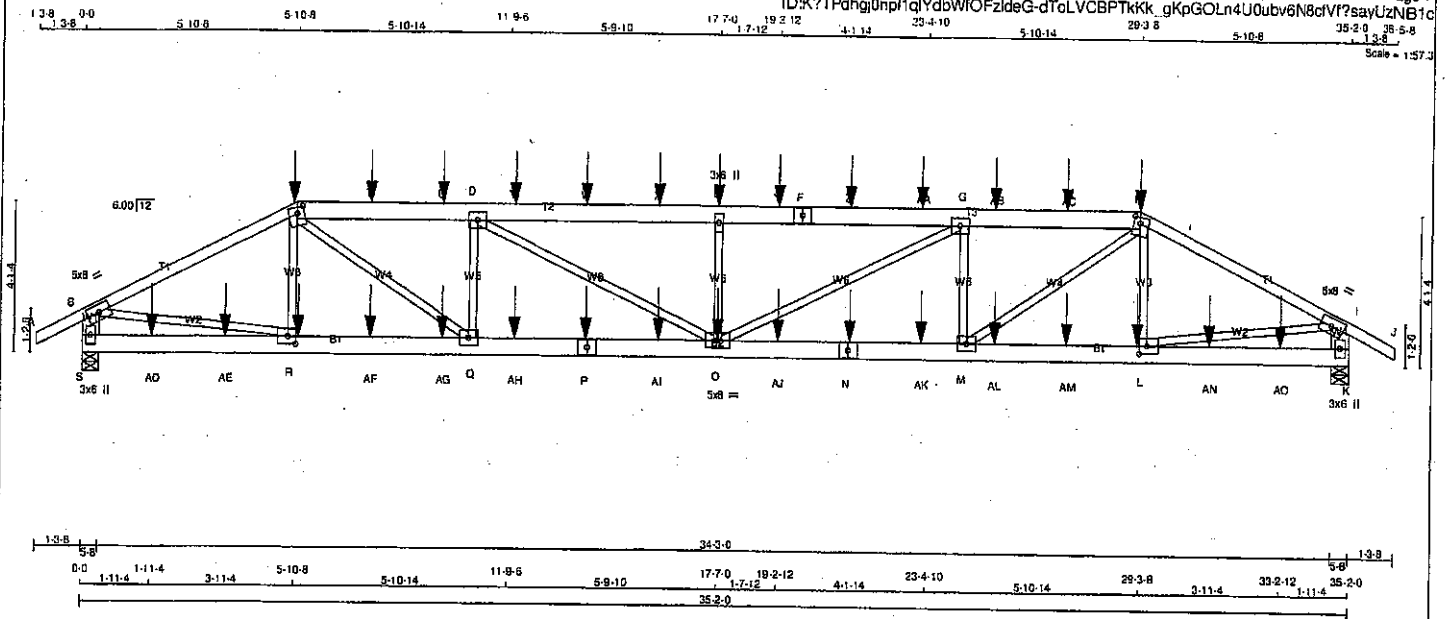

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - F	2x6	DRY	No.2	SPF	
F - H	2x6	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
S - B	2x6	DRY	No.2	SPF	
K - I	2x6	DRY	No.2	SPF	
S - P	2x6	DRY	No.2	SPF	
P - N	2x6	DRY	No.2	SPF	
N - K	2x6	DRY	No.2	SPF	

ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE(61.0)
H - J	12	SIDE(61.0)
C - F	12	SIDE(61.0)
F - H	12	SIDE(61.0)
S - B	12	TOP
K - I	12	TOP

BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS

CHORDS	MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORIZ. LOAD (PLF)	MAX. FACTORED TORSION (FT-LB)
A-B	0/28	-91.8	-91.8	0.07 (1)	10.00	0.06 (1)
B-C	-5069 / 0	-91.8	-91.8	0.52 (1)	3.87	0.37 (1)
C-T	-5978 / 0	-91.8	-91.8	0.24 (1)	4.35	0.19 (1)
T-U	-6978 / 0	-91.8	-91.8	0.24 (1)	4.35	0.17 (1)
U-D	-6978 / 0	-91.8	-91.8	0.24 (1)	4.35	0.13 (1)
D-Y	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	0.17 (1)
Y-W	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	0.19 (1)
W-X	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	0.37 (1)
X-E	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	0.08 (1)
E-Y	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	0.57 (1)
Y-F	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	0.57 (1)
F-Z	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	
Z-AA	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	
AA-G	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	
G-AB	-6978 / 0	-91.8	-91.8	0.24 (1)	4.35	
AB-AC	-6978 / 0	-91.8	-91.8	0.24 (1)	4.35	
AC-H	-8978 / 0	-91.8	-91.8	0.24 (1)	4.35	
H-I	-5069 / 0	-91.8	-91.8	0.52 (1)	3.87	
I-J	0/28	-91.8	-91.8	0.07 (1)	10.00	
S-B	-3250 / 0	0.0	0.0	0.11 (1)	7.69	
K-I	-3250 / 0	0.0	0.0	0.11 (1)	7.69	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	REQD BRG IN-SX
JT VERT	3331	0	0	5-8
S 3331	0	0	5-8	5-8
K 3331	0	0	5-8	5-8

UNFACTORED REACTIONS	1ST LCASE	MAX / MIN	COMPONENT REACTIONS
JT COMBINED	SNOW	LIVE	PERM. LIVE
S	2356	1544 / 0	0 / 0
K	2356	1544 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.87 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORIZ. LOAD (PLF)	MAX. FACTORED TORSION (FT-LB)
FR-TO						
A-B	0/28	-91.8	-91.8	0.07 (1)	10.00	0.06 (1)
B-C	-5069 / 0	-91.8	-91.8	0.52 (1)	3.87	0.37 (1)
C-T	-5978 / 0	-91.8	-91.8	0.24 (1)	4.35	0.19 (1)
T-U	-6978 / 0	-91.8	-91.8	0.24 (1)	4.35	0.17 (1)
U-D	-6978 / 0	-91.8	-91.8	0.24 (1)	4.35	0.13 (1)
D-Y	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	0.17 (1)
Y-W	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	0.19 (1)
W-X	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	0.37 (1)
X-E	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	0.08 (1)
E-Y	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	0.57 (1)
Y-F	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	0.57 (1)
F-Z	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	
Z-AA	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	
AA-G	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	
G-AB	-6978 / 0	-91.8	-91.8	0.24 (1)	4.35	
AB-AC	-6978 / 0	-91.8	-91.8	0.24 (1)	4.35	
AC-H	-8978 / 0	-91.8	-91.8	0.24 (1)	4.35	
H-I	-5069 / 0	-91.8	-91.8	0.52 (1)	3.87	
I-J	0/28	-91.8	-91.8	0.07 (1)	10.00	
S-B	-3250 / 0	0.0	0.0	0.11 (1)	7.69	
K-I	-3250 / 0	0.0	0.0	0.11 (1)	7.69	

S-AD	0 / 0	-18.5	-18.5	0.07 (4)	10.00
AD-AE	0 / 0	-18.5	-18.5	0.07 (4)	10.00
AE-R	0 / 0	-18.5	-18.5	0.07 (4)	10.00
R-AF	0 / 4557	-18.5	-18.5	0.33 (1)	10.00
AF-AG	0 / 4557	-18.5	-18.5	0.33 (1)	10.00
AG-Q	0 / 4557	-18.5	-18.5	0.33 (1)	10.00
Q-AH	0 / 6975	-18.5	-18.5	0.52 (1)	10.00
AH-P	0 / 6975	-18.5	-18.5	0.52 (1)	10.00
P-AI	0 / 6975	-18.5	-18.5	0.52 (1)	10.00
AI-O	0 / 6975	-18.5	-18.5	0.52 (1)	10.00
O-AJ	0 / 6975	-18.5	-18.5	0.52 (1)	10.00
AJ-N	0 / 6975	-18.5	-18.5	0.52 (1)	10.00
N-AK	0 / 6975	-18.5	-18.5	0.52 (1)	10.00
AK-M	0 / 6975	-18.5	-18.5	0.52 (1)	10.00
M-AL	0 / 4557	-18.5	-18.5	0.33 (1)	10.00
AL-AM	0 / 4557	-18.5	-18.5	0.33 (1)	10.00
AM-L	0 / 4557	-18.5	-18.5	0.33 (1)	10.00
L-AN	0 / 0	-18.5	-18.5	0.07 (4)	10.00
AN-AO	0 / 0	-18.5	-18.5	0.07 (4)	10.00
AO-K	0 / 0	-18.5	-18.5	0.07 (4)	10.00

TOTAL WEIGHT = 2 X 169 = 338 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
DL = 6.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD = 39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2010
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/960 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/960 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.29")

CSI: TC=0.52/1.00 (B-C:1), BC=0.52/1.00 (C-Q:1),
WB=0.57/1.00 (B-R:1), SS=0.16/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354
	1667	788
	1987	1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.90 (H) (INPUT = 0.90)
JSI METAL= 0.67 (P) (INPUT = 1.00)

CONTINUED ON PAGE 2

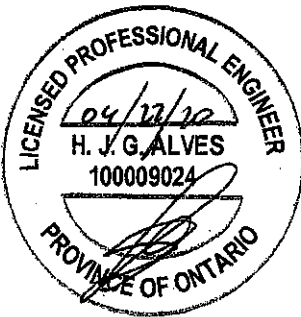

Structural component only
DWG# T-2007168 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T40	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.316 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:15 2020 Page 2
ID:K?TPdhaQ0np1qLYdbWIOFzdeG-dToLVCBPTkKk qKoGOLn4U0ubv6N8cIVi?savUzNB1c

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
B	TMW-t	MT20	5.0	8.0		
C	TTWW+m	MT20	5.0	8.0	2.00	2.25
D	TMW-t	MT20	5.0	6.0		
E	TMW-w	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMW-t	MT20	5.0	8.0		
H	TTWW+m	MT20	5.0	8.0	2.00	2.25
I	TMW-t	MT20	5.0	8.0		
K	BMV1+p	MT20	3.0	6.0		
L	BMW-t	MT20	5.0	6.0	2.50	2.50
M	BMW-t	MT20	5.0	6.0		
N	BS-t	MT20	5.0	6.0		
O	BMW-t	MT20	5.0	8.0		
P	BS-t	MT20	5.0	6.0		
Q	BMW-t	MT20	5.0	6.0		
R	BMW-t	MT20	5.0	6.0	2.50	2.50
S	BMV1+p	MT20	3.0	6.0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-437	-437	---	FRONT	VERT	TOTAL	---	C1
E	17-7-0	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	29-3-8	-437	-437	---	FRONT	VERT	TOTAL	---	C1
L	29-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
N	21-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
O	17-7-0	-26	-26	---	FRONT	VERT	TOTAL	---	C1
P	13-13-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	19-8-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	1-11-4	-25	-25	---	FRONT	VERT	TOTAL	---	C1
AE	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	19-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	23-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AL	25-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AM	27-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AN	31-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	33-2-12	-25	-25	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

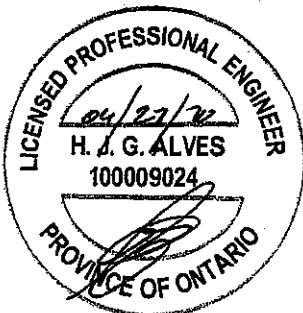

Structural component only
DWG# T-2007168

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T40Z	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:17 2020 Page 2
ID:K?TPdha0npl1qYdbWIOFzideG-arw5vuDI_MaSDzUBNpNF9v6Bulk?cSGo6JLh0NzNB1a

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	2.00	3.50
C	TTVW-m	MT20	6.0	9.0	Edge	
D	TMVW-l	MT20	5.0	8.0		
E	TMVW-w	MT20	3.0	6.0		
F	TS-l	MT20	5.0	6.0		
G	TMVW-l	MT20	5.0	8.0		
H	TTVW-m	MT20	6.0	9.0	Edge	
I	TMVW-p	MT20	5.0	8.0	2.00	3.50
K	BMV1-p	MT20	3.0	6.0		
L	BMVW-l	MT20	5.0	8.0	2.50	3.25
M	BMVW-l	MT20	8.0	9.0	4.50	2.50
N	BS-l	MT20	5.0	6.0		
O	BMVW-w	MT20	5.0	8.0		
P	BS-l	MT20	5.0	6.0		
Q	BMVW-l	MT20	6.0	9.0	4.50	2.50
R	BMVW-l	MT20	5.0	8.0	2.50	3.25
S	BMV1-p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007169

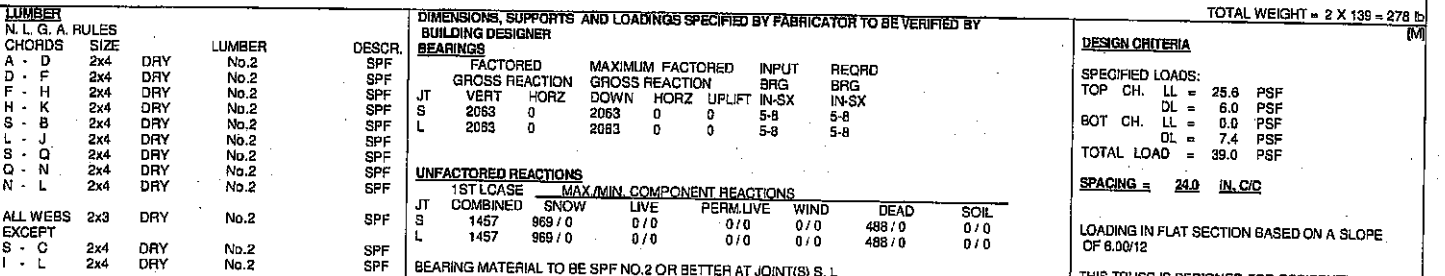

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.94 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.


JSI GRIP= 0.89 (L) (INPUT = 0.90)
JSI METAL= 0.77 (N) (INPUT = 1.00)



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T42	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 13:02:19 2020 Page 1
ID:K?TPdghi0npl1qYdbWfOfZldeG-WEZrKaEwWzr9THdaVEQjEKBSUWUW4PP4adqo5FzNB1Y

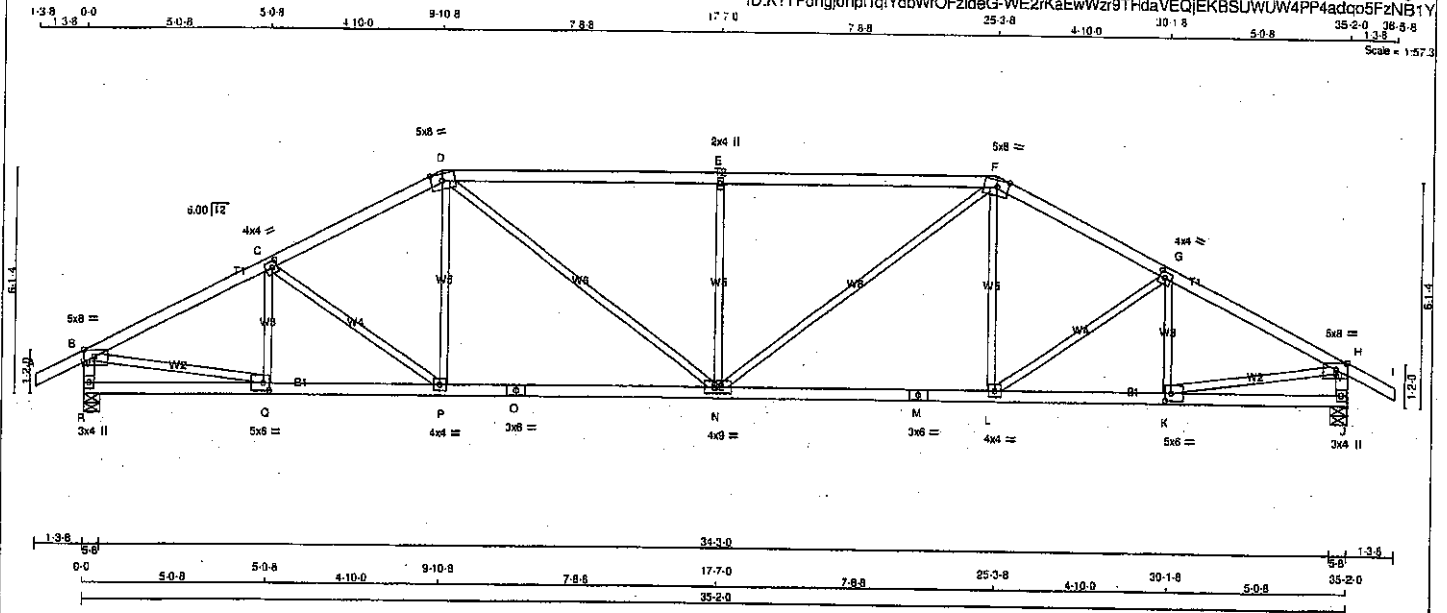

LUMBER	CHORDS	SIZE	DRY	LUMBER
N. L. G. A. RULES				
A - D	2x4	DRY	No.2	
D - F	2x4	DRY	No.2	
F - I	2x4	DRY	No.2	
I - L	2x4	DRY	No.2	
L - O	2x4	DRY	No.2	
O - M	2x4	DRY	No.2	
M - J	2x4	DRY	No.2	

ALL WEBS 2x3 DRY No.2
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	Edge 3.50	
C TMVW-l	MT20	4.0	4.0	2.00 1.75	
D TTWW-m	MT20	5.0	8.0	2.25 3.75	
E TMVW-w	MT20	2.0	4.0		
F TTWW-m	MT20	5.0	8.0	2.25 3.75	
G TMVW-l	MT20	4.0	4.0	2.00 1.75	
H TMVW-p	MT20	5.0	8.0	Edge 3.50	
J BMV1-p	MT20	3.0	4.0		
K BMVW-l	MT20	5.0	8.0	2.50 2.00	
L BMVW-l	MT20	4.0	4.0		
M BS-l	MT20	3.0	6.0		
N BMVW-l	MT20	4.0	4.0		
O BS-l	MT20	3.0	6.0		
P BMVW-l	MT20	4.0	4.0		
Q BMVW-l	MT20	5.0	8.0	2.50 2.00	
R BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	UP	IN-SX
R	2063	0	0	5-8
J	2063	0	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX/MIN. COMPONENT REACTIONS	2ND CASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
R	1457	969 / 0	0 / 0
J	1457	969 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.78 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO					FR-TO			
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	Q-C	-353 / 0	0.08 (1)
B-C	-2834 / 0	-91.8	-91.8	0.39 (1)	3.81	C-P	-210 / 0	0.13 (1)
C-D	-2687 / 0	-91.8	-91.8	0.37 (1)	3.91	P-D	0 / 246	0.06 (4)
D-E	-3060 / 0	-91.8	-91.8	0.97 (1)	2.78	D-N	0 / 844	0.19 (1)
E-F	-3060 / 0	-91.8	-91.8	0.97 (1)	2.78	N-E	-872 / 0	0.51 (1)
F-G	-2887 / 0	-91.8	-91.8	0.37 (1)	3.91	N-F	0 / 844	0.19 (1)
G-H	-2834 / 0	-91.8	-91.8	0.39 (1)	3.81	L-F	0 / 246	0.06 (4)
H-I	0 / 28	-91.8	-91.8	0.12 (1)	10.00	L-G	-210 / 0	0.13 (1)
I-J	-2018 / 0	0.0	0.0	0.20 (1)	5.94	K-G	-353 / 0	0.09 (1)
J-H	-2018 / 0	0.0	0.0	0.20 (1)	5.94	B-Q	0 / 2591	0.58 (1)
R-Q	0 / 0	-18.5	-18.5	0.10 (4)	10.00	K-H	0 / 2591	0.58 (1)
Q-P	0 / 2555	-18.5	-18.5	0.51 (1)	10.00			
P-O	0 / 2388	-18.5	-18.5	0.49 (1)	10.00			
O-N	0 / 2388	-18.5	-18.5	0.49 (1)	10.00			
N-M	0 / 2388	-18.5	-18.5	0.49 (1)	10.00			
M-L	0 / 2388	-18.5	-18.5	0.49 (1)	10.00			
L-K	0 / 2555	-18.5	-18.5	0.51 (1)	10.00			
K-J	0 / 0	-18.5	-18.5	0.10 (4)	10.00			

TOTAL WEIGHT = 2 X 139 = 277 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPC 2011, TPC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.17")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.34")

CSI: TC=0.97/1.00 (D-E:1), BC=0.51/1.00 (P-Q:1), WB=0.58/1.00 (B-Q:1), SS=0.34/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1665


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (F) (INPUT = 0.90)
JSI METAL = 0.75 (M) (INPUT = 1.00)

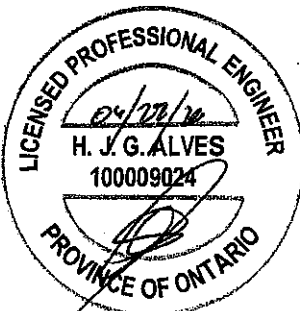

Structural component only
DWG# T-2007171

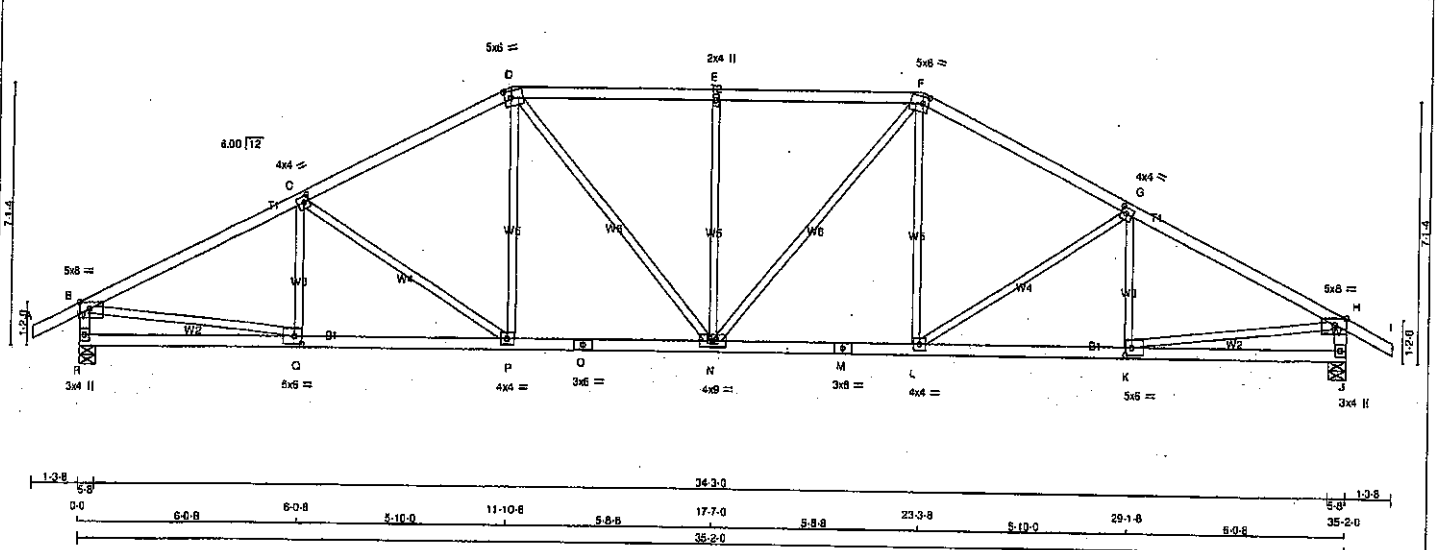

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - I	2x4	DRY No.2	SPF
R - B	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
R - O	2x4	DRY No.2	SPF
O - M	2x4	DRY No.2	SPF
M - J	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge 3.50	
C	TMVW-l	MT20	4.0	4.0	2.00 1.75	
D	TTWW-m	MT20	5.0	6.0	2.25 2.00	
E	TMVW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.25 2.00	
G	TMVW-l	MT20	4.0	4.0	2.00 1.75	
H	TMVW-p	MT20	5.0	8.0	Edge 3.50	
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-l	MT20	6.0	8.0	2.50 2.25	
L	BMVW-l	MT20	4.0	4.0		
M	BS-l	MT20	3.0	6.0		
N	BMVW-w	MT20	4.0	8.0		
O	BS-l	MT20	3.0	6.0		
P	BMVW-l	MT20	4.0	4.0		
Q	BMVW-l	MT20	5.0	8.0	2.50 2.25	
R	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
JT	2083	0	2083	0	5-8	5-8
J	2083	0	2083	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX/MIN COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
R	1457	969 / 0	0 / 0	0 / 0	0 / 0	468 / 0	0 / 0
J	1457	969 / 0	0 / 0	0 / 0	0 / 0	468 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD	LC1 P/LF	MAX CS1 (LC)	MAX. UNBRAC FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)
FR-TO		FROM	TO					
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	Q-C	-255 / 12	0.07 (1)
B-C	-2889 / 0	-91.8	-91.8	0.59 (1)	3.58	C-P	-435 / 0	0.42 (1)
C-D	-2539 / 0	-91.8	-91.8	0.52 (1)	3.63	P-D	0 / 350	0.08 (1)
D-E	-2559 / 0	-91.8	-91.8	0.48 (1)	3.65	D-N	0 / 482	0.11 (1)
E-F	-2569 / 0	-91.8	-91.8	0.48 (1)	3.65	N-E	-641 / 0	0.58 (1)
F-G	-2539 / 0	-91.8	-91.8	0.52 (1)	3.63	L-F	0 / 482	0.08 (1)
G-H	-2889 / 0	-91.8	-91.8	0.58 (1)	3.58	H-F	0 / 350	0.11 (1)
H-I	0 / 28	-91.8	-91.8	0.12 (1)	10.00	L-G	-435 / 0	0.42 (1)
I-J	-2014 / 0	0.0	0.0	0.20 (1)	5.95	K-G	-255 / 12	0.07 (1)
J-H	-2014 / 0	0.0	0.0	0.20 (1)	5.95	B-Q	0 / 2635	0.59 (1)
						K-H	0 / 2635	0.59 (1)
R-Q	0 / 0	-18.5	-18.5	0.15 (4)	10.00			
Q-P	0 / 2809	-18.5	-18.5	0.49 (1)	10.00			
P-O	0 / 2249	-18.5	-18.5	0.43 (1)	10.00			
O-N	0 / 2249	-18.5	-18.5	0.43 (1)	10.00			
N-M	0 / 2249	-18.5	-18.5	0.43 (1)	10.00			
M-L	0 / 2249	-18.5	-18.5	0.43 (1)	10.00			
L-K	0 / 2509	-18.5	-18.5	0.49 (1)	10.00			
K-J	0 / 0	-18.5	-18.5	0.15 (4)	10.00			

TOTAL WEIGHT = 2 X 145 = 289 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	PSF
DL	6.0	PSF
BOT CH.	LL	PSF
DL	7.4	PSF
TOTAL LOAD	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.26")

CS1: TC=0.58/1.00 (B-C:1), BC=0.49/1.00 (P-Q:1), WB=0.59/1.00 (B-Q:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (Q) (INPUT = 0.90)
JSI METAL = 0.59 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007172


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T44	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 20 2019 Mitek Industries, Inc. Sat Apr 25 13:02:21 2020 Page 1

ID:K?7TPdhgJOnpl1qYdbWfOFzideG-SdAdGGA2a5lbnycfSBKIGrDK9fYJhN1xJv98zNB1W

Scale = 1:50.0

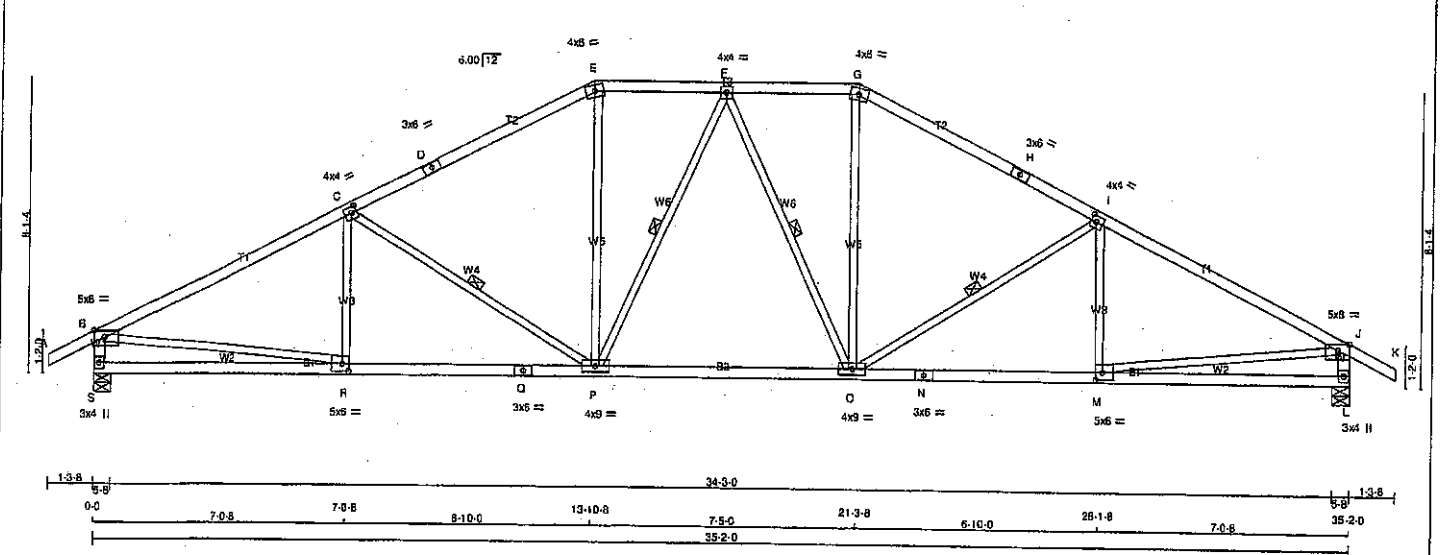

LUMBER		CHORDS		SIZE		DRY		NO.2		DESCR.	
A - D	2x4	DRY	No.2	SPF							
D - E	2x4	DRY	No.2	SPF							
E - G	2x4	DRY	No.2	SPF							
G - H	2x4	DRY	No.2	SPF							
H - K	2x4	DRY	No.2	SPF							
S - B	2x4	DRY	No.2	SPF							
L - J	2x4	DRY	No.2	SPF							
S - Q	2x4	DRY	No.2	SPF							
Q - N	2x4	DRY	No.2	SPF							
N - L	2x4	DRY	No.2	SPF							
ALL WEBS	2x3	DRY	No.2	SPF							
EXCEPT											

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	8.0	Edge	3.50
C	TMWV-l	MT20	4.0	4.0	2.00	1.75
D	TS-l	MT20	3.0	6.0		
E	TTW-m	MT20	4.0	6.0		
F	TMWV-l	MT20	4.0	4.0		
G	TTW-m	MT20	4.0	6.0		
H	TS-l	MT20	3.0	6.0		
I	TMWV-l	MT20	4.0	4.0	2.00	1.75
J	TMWV-p	MT20	5.0	8.0	Edge	3.50
L	BMV1-p	MT20	3.0	4.0		
M	BMWV-l	MT20	5.0	6.0	2.50	2.25
N	BS-l	MT20	3.0	6.0		
O	BMWV-w	MT20	4.0	9.0		
P	BMWV-w	MT20	4.0	9.0		
Q	BS-l	MT20	3.0	6.0		
R	BMWV-l	MT20	5.0	6.0	2.50	2.25
S	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
S	2063	0	0	2063	0	0	5-8	5-8	5-8
L	2063	0	0	2063	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN	COMPONENT REACTIONS	DEAD	SOIL
S	1457	999 / 0	0 / 0	0 / 0	0 / 0
L	1457	999 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-P, F-P, F-Q, H-Q.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED	MEMB.	MAX. FACTORED
FR-TO	FORCE (LBS)	FR-TO	FORCE (LBS)
A-B	0 / 28	R-C	-182 / 52
B-C	-2806 / 0	C-P	-637 / 0
C-D	-2373 / 0	P-E	0 / 674
D-E	-2373 / 0	E-F	-222 / 0
E-F	-2100 / 0	F-G	0 / 674
F-G	-2100 / 0	G-H	-637 / 0
G-H	-2373 / 0	H-I	-182 / 52
H-I	-2373 / 0	I-J	0 / 2649
I-J	-2906 / 0	J-K	0 / 2649
J-K	0 / 28	K-L	0 / 0
K-L	-2008 / 0	L-M	0 / 0
L-M	-2008 / 0	M-N	0 / 0
M-N	0 / 0	N-O	0 / 0
N-O	0 / 0	O-P	0 / 0
O-P	0 / 0	P-Q	0 / 0
P-Q	0 / 0	Q-R	0 / 0
Q-R	0 / 0	R-S	0 / 0
R-S	0 / 0	S-T	0 / 0
S-T	0 / 0	T-U	0 / 0
T-U	0 / 0	U-V	0 / 0
U-V	0 / 0	V-W	0 / 0
V-W	0 / 0	W-X	0 / 0
W-X	0 / 0	X-Y	0 / 0
X-Y	0 / 0	Y-Z	0 / 0
Y-Z	0 / 0	Z-A	0 / 0
Z-A	0 / 0	A-B	0 / 0

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPC 2014

(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CSI: TC=0.83/1.00 (B-C-1), BC=0.52/1.00 (P-R-1),
WB=0.60/1.00 (B-R-1), SS=0.28/1.00 (B-C-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (M) (INPUT = 0.80)
JSI METAL= 0.79 (Q) (INPUT = 1.00)

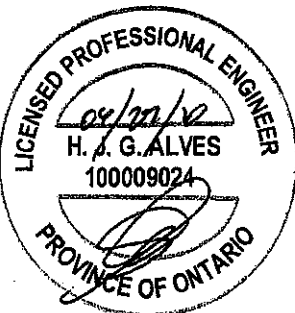


Structural component only
DWG# T-2007173

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T45	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:22 2020 Page 1
ID:K?TPdhqj0npl1qYdbWfOfzIdeG-wp1_zbGopuDKIM9AMzQsy6jVPHiyXGb2SiazNB1V

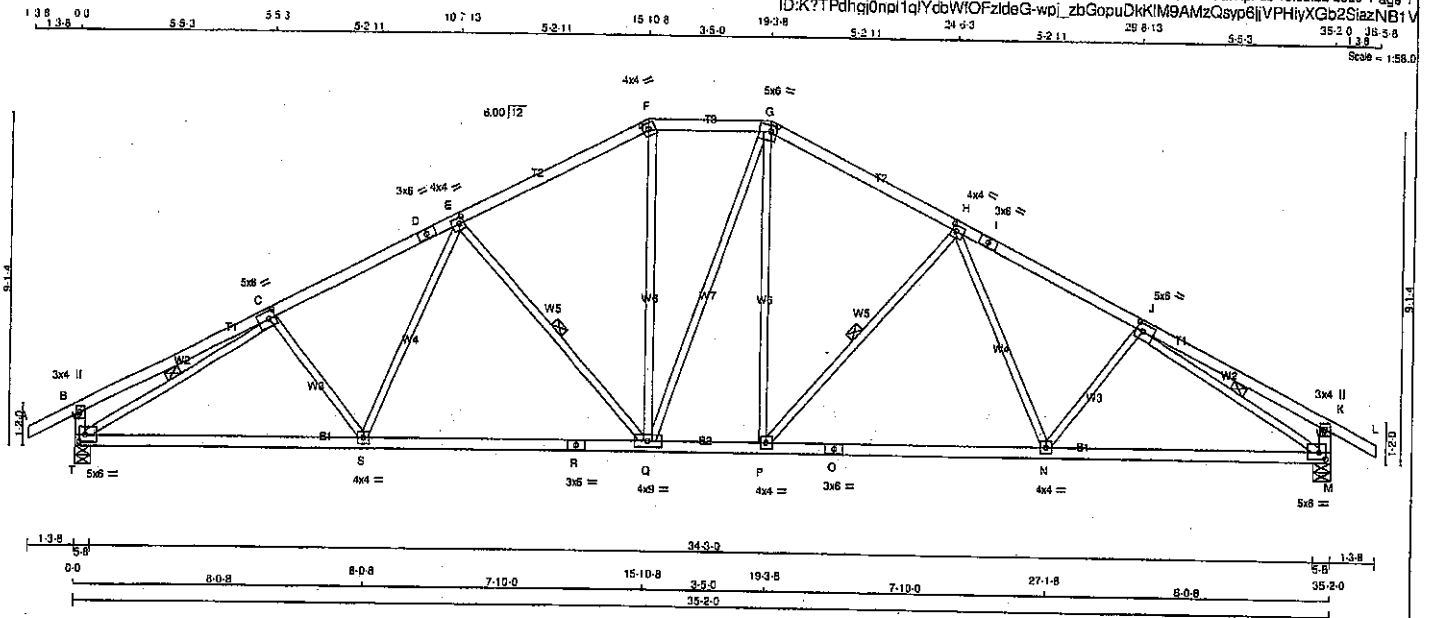

LUMBER	N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - G	2x4	DRY	No.2	SPF	
G - I	2x4	DRY	No.2	SPF	
I - L	2x4	DRY	No.2	SPF	
T - B	2x4	DRY	No.2	SPF	
M - K	2x4	DRY	No.2	SPF	
T - R	2x4	DRY	No.2	SPF	
R - O	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-1	MT20	5.0	6.0	2.50	2.25
D	TS-1	MT20	3.0	6.0		
E	TMWW-1	MT20	4.0	4.0	2.00	1.50
F	TTW-h	MT20	4.0	4.0	2.00	1.75
G	TTWW-m	MT20	5.0	6.0	2.00	2.00
H	TMWW-1	MT20	4.0	4.0	2.00	1.50
I	TS-1	MT20	3.0	6.0		
J	TMWW-1	MT20	5.0	6.0	2.50	2.25
K	TMV+p	MT20	3.0	4.0		
M	BMVW-1	MT20	5.0	6.0	2.25	2.00
N, P, S						
N	BMWW-1	MT20	4.0	4.0		
Q	BS-1	MT20	3.0	6.0		
R	BS-1	MT20	4.0	6.0		
T	BMVW-1	MT20	5.0	6.0	2.25	2.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
T	2063	0	2063	0	5-8	5-8
M	2063	0	2063	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED		MAX./MIN. COMPONENT REACTIONS		DEAD	SOIL
	SNOW	LIVE	PERM.LIVE	WIND		
T	1457	989 / 0	0 / 0	0 / 0	488 / 0	0 / 0
M	1457	989 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.86 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, H-P, C-T, J-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	C-S	-110 / 37 0.04 (1)
B-C	0 / 19	-91.8	-91.8	0.32 (1)	10.00	S-E	0 / 276 0.08 (1)
C-D	-2759 / 0	-91.8	-91.8	0.40 (1)	3.86	E-Q	-881 / 0 0.31 (1)
D-E	-2759 / 0	-91.8	-91.8	0.40 (1)	3.86	Q-F	0 / 613 0.14 (1)
E-F	-2167 / 0	-91.8	-91.8	0.38 (1)	4.30	G-Q	0 / 4 0.00 (1)
F-G	-1925 / 0	-91.8	-91.8	0.18 (1)	4.71	P-G	0 / 609 0.14 (1)
G-H	-2168 / 0	-91.8	-91.8	0.38 (1)	4.30	P-H	-882 / 0 0.31 (1)
H-I	-2760 / 0	-91.8	-91.8	0.40 (1)	3.86	H-N	0 / 278 0.06 (1)
I-J	-2760 / 0	-91.8	-91.8	0.40 (1)	3.86	N-J	-110 / 37 0.04 (1)
J-K	0 / 19	-91.8	-91.8	0.32 (1)	10.00	T-C	-3040 / 0 0.85 (1)
K-L	0 / 28	-91.8	-91.8	0.12 (1)	10.00	J-M	-3041 / 0 0.85 (1)
T-B	-328 / 0	0.0	0.0	0.03 (1)	7.81		
M-K	-328 / 0	0.0	0.0	0.03 (1)	7.81		
T-S	0 / 2536	-18.5	-18.5	0.55 (1)	10.00		
S-R	0 / 2362	-18.5	-18.5	0.53 (1)	10.00		
R-Q	0 / 2362	-18.5	-18.5	0.53 (1)	10.00		
Q-P	0 / 1924	-18.5	-18.5	0.40 (1)	10.00		
P-O	0 / 2362	-18.5	-18.5	0.53 (1)	10.00		
O-N	0 / 2362	-18.5	-18.5	0.53 (1)	10.00		
N-M	0 / 2537	-18.5	-18.5	0.55 (1)	10.00		

TOTAL WEIGHT = 2 X 151 = 302 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT. CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.32")

CSI: TC=0.40/1.00 (H-J:1), BC=0.56/1.00 (M-N:1), WB=0.85/1.00 (J-M:1), SS=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (M) (INPUT = 0.90)
JSI METAL = 0.78 (O) (INPUT = 1.00)

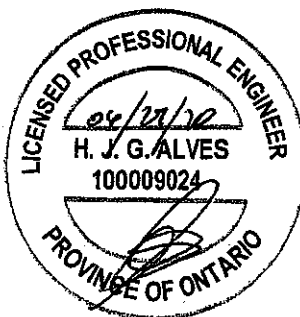

Structural component only
DWG# T-2007174

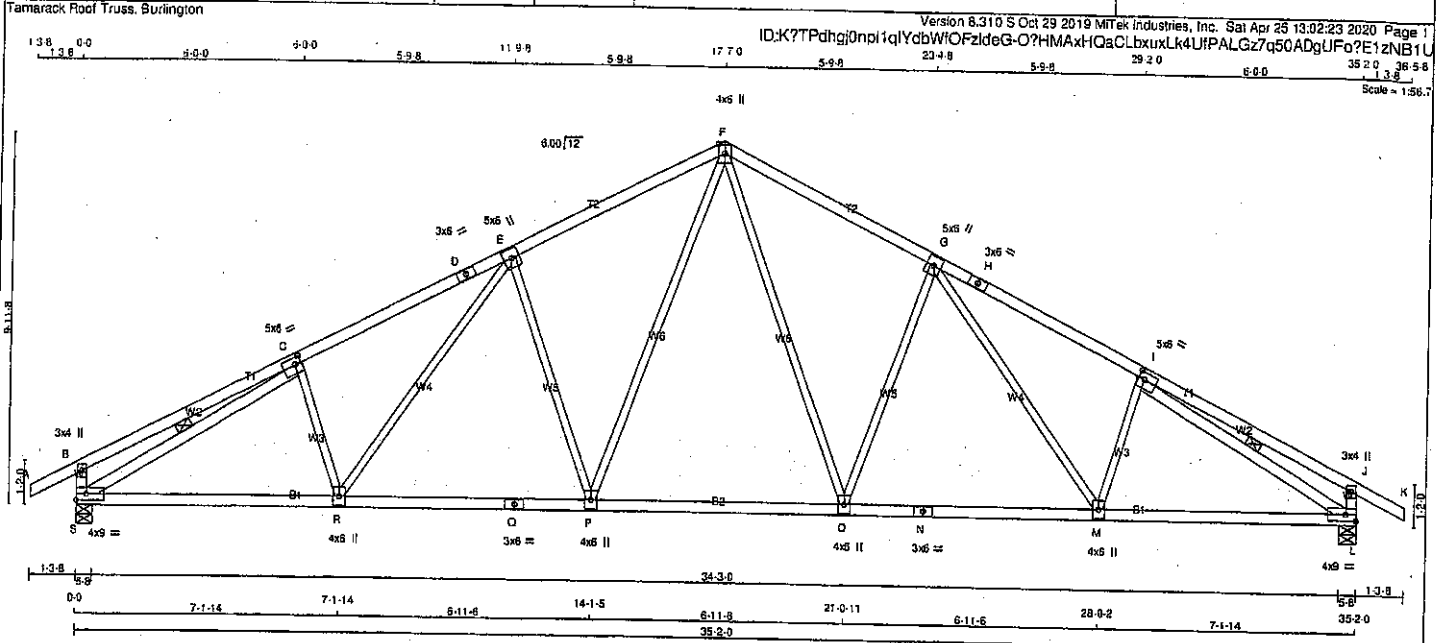

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - H	2x4	DRY No.2	SPF
H - K	2x4	DRY No.2	SPF
S - B	2x4	DRY No.2	SPF
L - J	2x4	DRY No.2	SPF
S - Q	2x4	DRY No.2	SPF
Q - N	2x4	DRY No.2	SPF
N - L	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x6	DRY No.2	SPF
S - C	2x4	DRY No.2	SPF
I - L	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-I	MT20	5.0	8.0	2.25	2.00
D	TS-I	MT20	3.0	6.0		
E	TMWW-I	MT20	5.0	8.0		
F	TTWW+p	MT20	4.0	6.0	Edge	
G	TMWW-I	MT20	5.0	8.0		
H	TS-I	MT20	3.0	6.0		
I	TMWW-I	MT20	5.0	8.0	2.25	2.00
J	TMV+p	MT20	3.0	4.0		
L	BMVW-I	MT20	4.0	9.0	Edge	
M, O, P, R	BMVW-I	MT20	4.0	6.0		
N	BS-I	MT20	3.0	6.0		
Q	BS-I	MT20	3.0	6.0		
S	BMVW-I	MT20	4.0	9.0	Edge	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	REQRD BRG IN-SX
JT VERT	2063	0	5-8	5-8
S	2063	0	5-8	5-8
L	2063	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
S	1457	999 / 0	0 / 0	488 / 0	0 / 0
L	1457	999 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLINE SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, L-L

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO				FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	F-O	0 / 866	0.19 (1)	
B-C	0 / 22	-91.8	-91.8 0.40 (1)	O-G	-726 / 0	0.72 (1)	
C-D	-2808 / 0	-91.8	-91.8 0.49 (1)	G-M	0 / 391	0.09 (1)	
D-E	-2808 / 0	-91.8	-91.8 0.49 (1)	M-I	-192 / 18	0.05 (1)	
E-F	-2322 / 0	-91.8	-91.8 0.46 (1)	I-P	0 / 866	0.19 (1)	
F-G	-2322 / 0	-91.8	-91.8 0.46 (1)	P-E	-726 / 0	0.72 (1)	
G-H	-2808 / 0	-91.8	-91.8 0.49 (1)	E-P	0 / 391	0.09 (1)	
H-I	-2808 / 0	-91.8	-91.8 0.49 (1)	P-R	-192 / 18	0.05 (1)	
I-J	0 / 22	-91.8	-91.8 0.40 (1)	R-E	0 / 391	0.09 (1)	
J-K	0 / 28	-91.8	-91.8 0.12 (1)	E-R	-3094 / 0	0.72 (1)	
K-L	-344 / 0	0.0	0.0 0.03 (1)	R-L	-3064 / 0	0.72 (1)	
L-J	-344 / 0	0.0	0.0 0.03 (1)				
S-R	0 / 2574	-18.5	-18.5 0.53 (1)				
R-Q	0 / 2291	-18.5	-18.5 0.47 (1)				
Q-P	0 / 2291	-18.5	-18.5 0.47 (1)				
P-O	0 / 1762	-18.5	-18.5 0.38 (1)				
O-N	0 / 2291	-18.5	-18.5 0.47 (1)				
N-M	0 / 2291	-18.5	-18.5 0.47 (1)				
M-L	0 / 2574	-18.5	-18.5 0.53 (1)				

TOTAL WEIGHT = 6 X 152 = 910 lb

(M/F)

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = L/999 (0.14)
ALLOWABLE DEFL.(TL) = L/360 (1.17)
CALCULATED VERT. DEFL.(TL) = L/999 (0.28)

CSI: TC=0.49/1.00 (G-I:1), BC=0.53/1.00 (R-S:1), WB=0.72/1.00 (E-P:1), SS=0.22/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.87 (C) (INPUT = 0.90)
JSI METAL = 0.77 (I) (INPUT = 1.00)



Structural component only
DWG# T-2007175

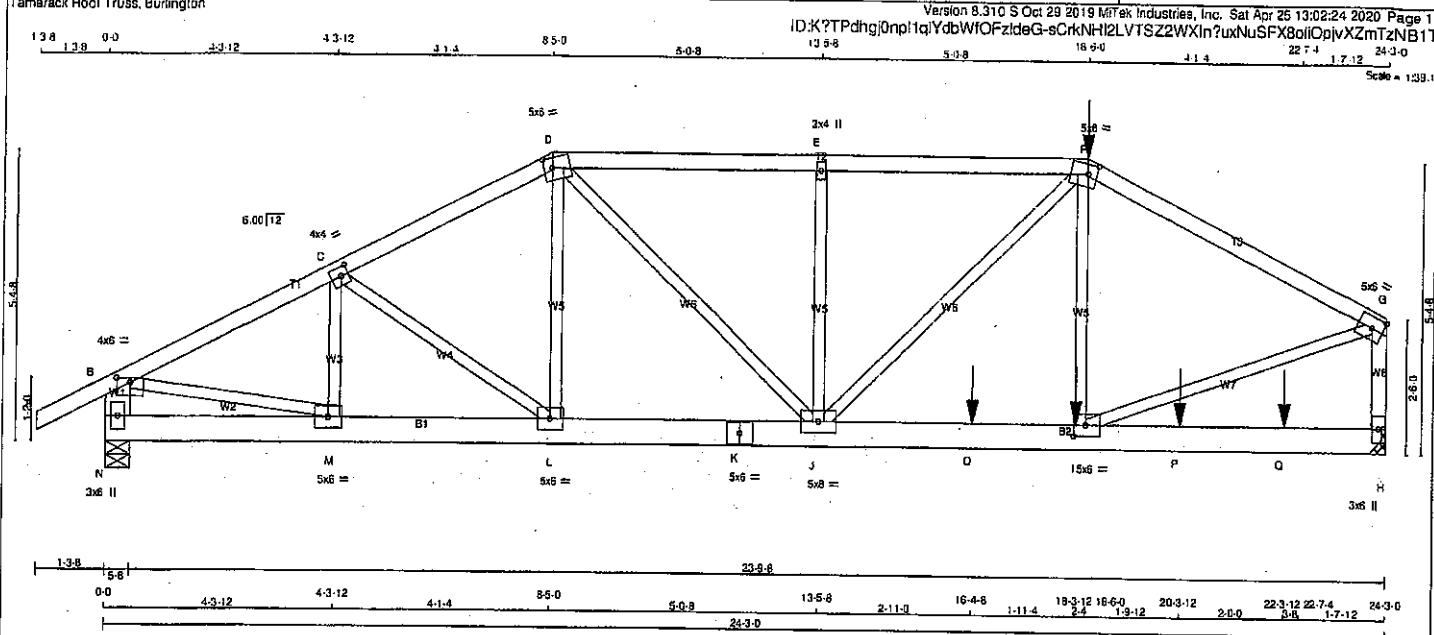

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
N - B	2x6	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF
N - K	2x6	DRY	No.2	SPF
K - H	2x6	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.
DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-D	12	TOP
D-F	12	SIDE(61.0)
F-G	12	SIDE(61.0)
H-G	12	TOP
N-B	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
N-K	12	TOP
K-H	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	RECORD BRG IN-SX
JT VERT 2120	0	0	5-8
N 2120	0	0	5-8
H 3119	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 4'-0".

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED SNOW	LIVE PERM. LIVE WIND DEAD SOIL
N 1495	1003 / 0 0 / 0 0 / 0 492 / 0 0 / 0
H 2201	1472 / 0 0 / 0 0 / 0 0 / 0 729 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.64 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. FACTORED CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)	
A-B	0 / 28	-91.8	-91.8 0.07 (1)	10.00	M-C	-408 / 0	0.04 (1)
B-C	-2614 / 0	-91.8	-91.8 0.17 (1)	5.22	C-L	-66 / 0	0.01 (1)
C-D	-2692 / 0	-91.8	-91.8 0.17 (1)	5.24	L-D	0 / 70	0.01 (4)
D-E	-3517 / 0	-91.8	-91.8 0.27 (1)	4.74	D-J	0 / 1336	0.17 (1)
E-F	-3517 / 0	-91.8	-91.8 0.27 (1)	4.74	J-E	-555 / 0	0.12 (1)
F-G	-3466 / 0	-91.8	-91.8 0.39 (1)	4.64	J-F	0 / 575	0.07 (1)
N-B	-2064 / 0	0.0	0.0 0.07 (1)	7.81	I-F	0 / 522	0.06 (1)
H-G	-2833 / 0	0.0	0.0 0.20 (1)	6.72	I-G	0 / 3293	0.41 (1)
					B-M	0 / 2664	0.33 (1)
N-M	0 / 0	-18.5	-18.5 0.03 (1)	10.00			
M-L	0 / 2622	-18.5	-18.5 0.21 (1)	10.00			
L-K	0 / 2568	-18.5	-18.5 0.33 (1)	10.00			
K-J	0 / 2568	-18.5	-18.5 0.33 (1)	10.00			
J-O	0 / 3109	-18.5	-18.5 0.69 (1)	10.00			
O-I	0 / 3109	-18.5	-18.5 0.69 (1)	10.00			
I-P	0 / 0	-18.5	-18.5 0.32 (1)	10.00			
P-Q	0 / 0	-18.5	-18.5 0.32 (1)	10.00			
Q-H	0 / 0	-18.5	-18.5 0.32 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	18-6-0	-178	-178	---	FRONT	VERT	TOTAL	---	C1
I	18-3-12	-35	-35	---	FRONT	VERT	TOTAL	---	C1
O	16-4-8	-1661	-1661	---	FRONT	VERT	TOTAL	---	C1
P	20-3-12	-283	-283	---	FRONT	VERT	TOTAL	---	C1
Q	22-3-12	-284	-284	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 114 = 228 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.81")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.39/1.00 (F-G:1), BC=0.69/1.00 (I-J:1), WB=0.41/1.00 (G-I:1), SS=0.37/1.00 (J-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1666

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.87 (I) (INPUT = 0.93)
JSI METAL = 0.44 (G) (INPUT = 1.00)

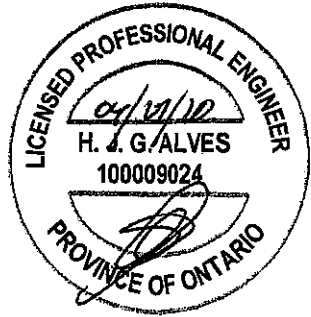

Structural component only
DWG# T-2007176 92

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T47	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:24 2020 Page 2
ID:K?TPdhtgi0npl1qYqbWfOFzdeG-sCrkNH12LVTSZ2WXIn?uxNuSFX8oI0pivXZmTzNB11

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	6.0	1.00	3.00
C	TMWW-I	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	6.0	2.25	2.00
E	TMW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.25	2.00
G	TMVW-I	MT20	5.0	6.0		Edge
H	BMV1-p	MT20	3.0	6.0		
I	BMWW-I	MT20	5.0	6.0	2.50	2.75
J	BMWWW-I	MT20	5.0	8.0		
K	BS-I	MT20	5.0	6.0		
L	BMWW-I	MT20	5.0	6.0		
M	BMWW-I	MT20	5.0	6.0		
N	BMV1-p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2007176 42

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T48	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:25 2020 Page 1
ID:K?TPdhgJ0npl1qIYdbWIOFzideG-L0P7bdJg6pbJBC5krUX7UbRcdXZ9U3GzyZH6ivzNB1S

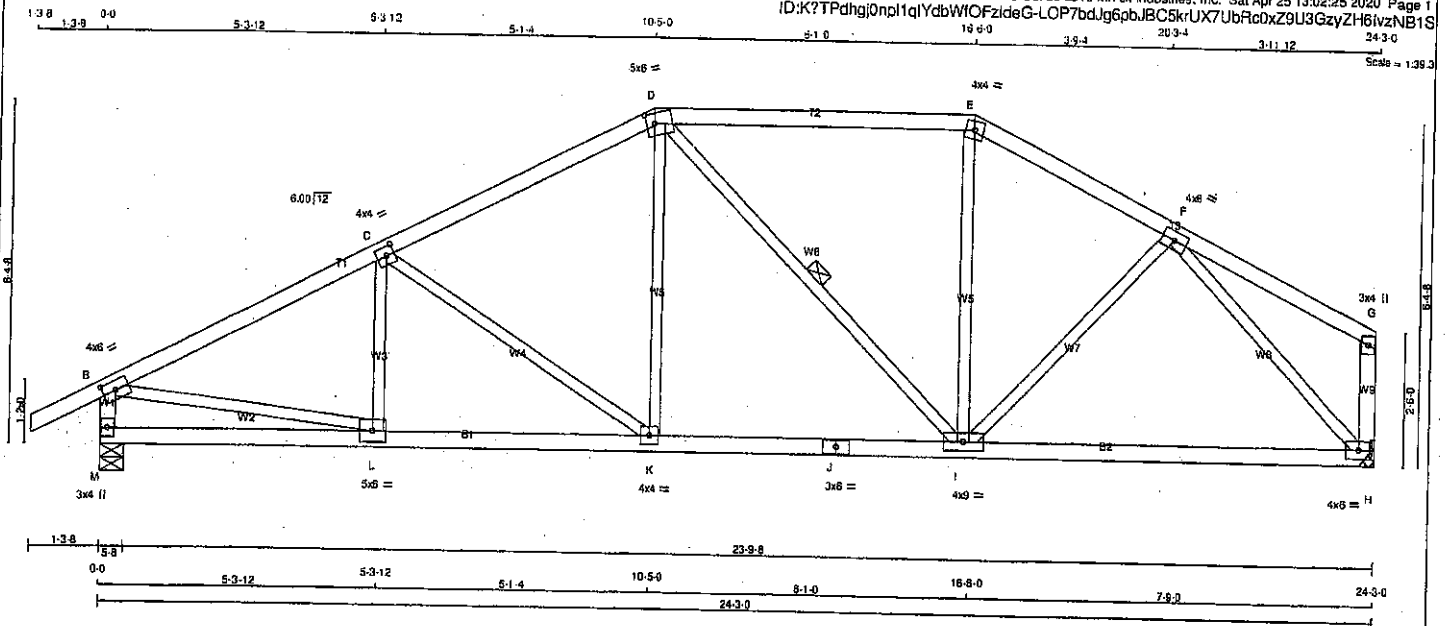

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	DRY	NO.2
A - D	2x4	DRY	No.2	
D - E	2x4	DRY	No.2	
E - G	2x4	DRY	No.2	
M - B	2x4	DRY	No.2	
H - G	2x4	DRY	No.2	
M - J	2x4	DRY	No.2	
J - H	2x4	DRY	No.2	

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	8.0	2.00	3.00
C	TMVW-1	MT20	4.0	4.0	2.00	1.75
D	TTWV-m	MT20	5.0	6.0	2.25	2.00
E	TTW-m	MT20	4.0	4.0		
F	TMVW-1	MT20	4.0	6.0		
G	TMV+p	MT20	3.0	4.0		
H	BMVW1-k	MT20	4.0	6.0		
I	BS-1	MT20	4.0	9.0		
J	BS-1	MT20	3.0	6.0		
K	BMVW-1	MT20	4.0	4.0		
L	BMVW-1	MT20	5.0	6.0		
M	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UP
M	1461	0	1461	0
H	1337	0	1337	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
M	1031	880 / 0	0 / 0	0 / 0	341 / 0
H	945	620 / 0	0 / 0	0 / 0	325 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D4.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 MAX (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 / 28	-91.8 -91.8 0.12 (1)	L-C	-185 / 32
B-C	-1844 / 0	-91.8 -91.8 0.36 (1)	C-K	-438 / 0
C-D	-1488 / 0	-91.8 -91.8 0.34 (1)	K-D	0 / 334
D-E	-1181 / 0	-91.8 -91.8 0.46 (1)	D-I	-189 / 0
E-F	-1336 / 0	-91.8 -91.8 0.18 (1)	I-E	0 / 175
F-G	0 / 18	-91.8 -91.8 0.21 (1)	I-F	0 / 156
M-B	-1419 / 0	0.0 0.0 0.14 (1)	B-L	0 / 1892
H-G	-138 / 0	0.0 0.0 0.02 (1)	F-H	-1583 / 0
M-L	0 / 0	-18.5 -18.5 0.12 (4)		
L-K	0 / 1671	-18.5 -18.5 0.32 (1)		
K-J	0 / 1313	-18.5 -18.5 0.36 (4)		
J-I	0 / 1313	-18.5 -18.5 0.36 (4)		
I-H	0 / 1069	-18.5 -18.5 0.34 (4)		

TOTAL WEIGHT = 99 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.81")
CALCULATED VERT. DEFL.(LL) = L/899 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.46/1.00 (D-E:1), BC=0.36/1.00 (I-K:4), WB=0.82/1.00 (F-H:1), SS=0.22/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 L.S BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.50 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007177

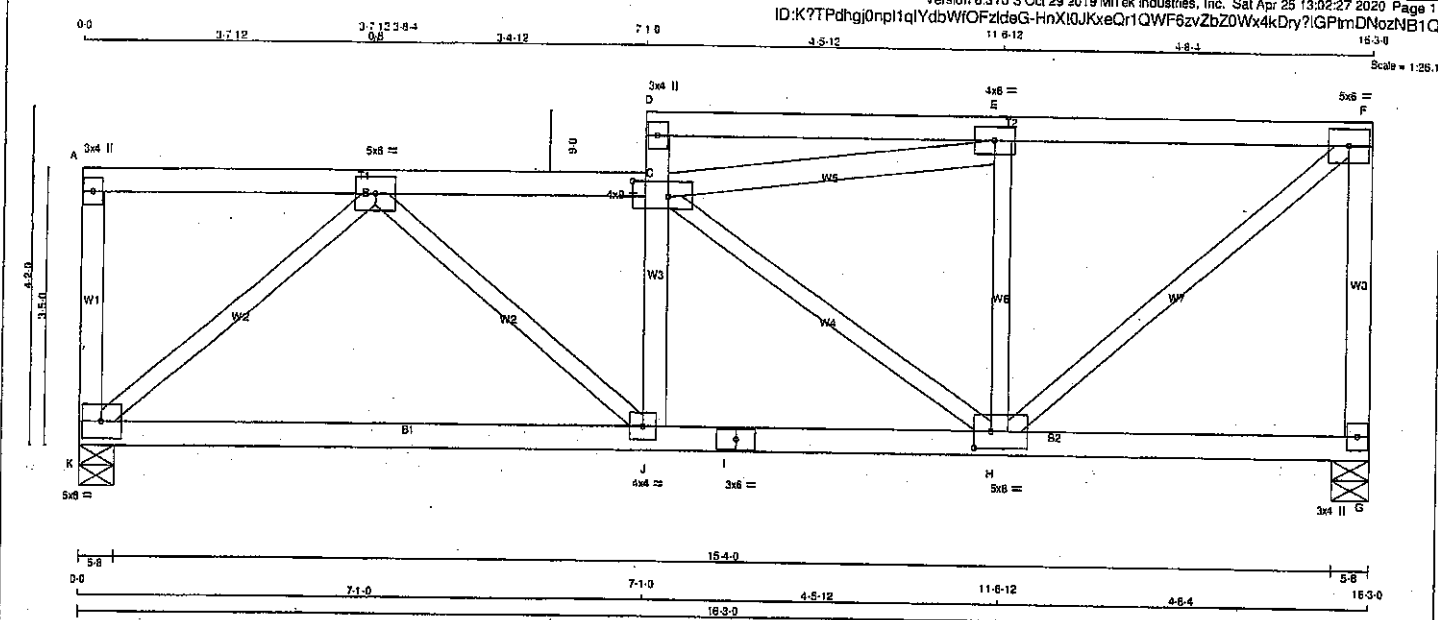

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
K - A	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
J - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
C - E	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B	TMVW-i	MT20	5.0	6.0		
C	TMVW-i	MT20	4.0	9.0	2.25	5.50
D	TMV+p	MT20	3.0	4.0		
E	TMVW-i	MT20	4.0	6.0		
F	TMVW-i	MT20	5.0	6.0		
G	BMV1+p	MT20	3.0	4.0		
H	BMVW-i	MT20	5.0	8.0	2.50	2.50
I	BS-i	MT20	3.0	6.0		
J	BMVW-i	MT20	4.0	4.0		
K	BMVW-i	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	UPLIFT	IN-SX
K	1079	0	0	5-8
G	1079	0	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX./MIN. COMPONENT REACTIONS
JT	COMBINED
K	780
G	780

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.47 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
K-A	-163 / 0	0.0	0.04 (1)	K-B	-1328 / 0	0.65 (1)	7.81
A-B	0 / 0	-114.3	-114.3 0.32 (1)	B-J	0 / 538	0.16 (1)	10.00
B-C	-1416 / 0	-114.3	-114.3 0.37 (1)	C-E	-981 / 0	0.30 (1)	4.47
J-C	-226 / 0	0.0	0.08 (1)	C-H	-489 / 0	0.30 (1)	7.81
C-D	-183 / 0	0.0	0.08 (1)	H-E	-471 / 0	0.16 (1)	7.81
D-E	-58 / 0	-114.3	-114.3 0.51 (1)	E-F	0 / 1303	0.39 (1)	6.25
E-F	-1004 / 0	-114.3	-114.3 0.55 (1)	F-G			4.81
G-F	-1039 / 0	0.0	0.37 (1)				6.91
K-J	0 / 1013	-18.5	-18.5 0.41 (4)				10.00
J-I	0 / 1402	-18.5	-18.5 0.48 (4)				10.00
I-H	0 / 1402	-18.5	-18.5 0.48 (4)				10.00
H-G	0 / 0	-18.5	-18.5 0.13 (4)				10.00

TOTAL WEIGHT = 3 X 72 = 216 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 15.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD = 48.0 PSF	

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 8 OF NBCC 2018, QBC 2012, ABC 2019
- PART 8 OF QBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")

CALCULATED VERT. DEFL.(LL) = L/999 (0.03")

ALLOWABLE DEFL.(TL) = L/360 (0.54")

CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TC=0.55/1.00 (E-F:1), BC=0.48/1.00 (H-J:4), WB=0.85/1.00 (B-K:1), SS=0.34/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1867 788	1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (C) (INPUT = 0.80)

JSI METAL= 0.82 (I) (INPUT = 1.00)




Structural component only
DWG# T-2007178

JOB NAME 408170	TRUSS NAME T50	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:28 2020 Page 1
ID:K?TPdhg0npl1qYdbW/OZdeG-lz5FDILZPkzu2gpjXd4q6D3AB6cJhXEPeXVmwEzNB1P

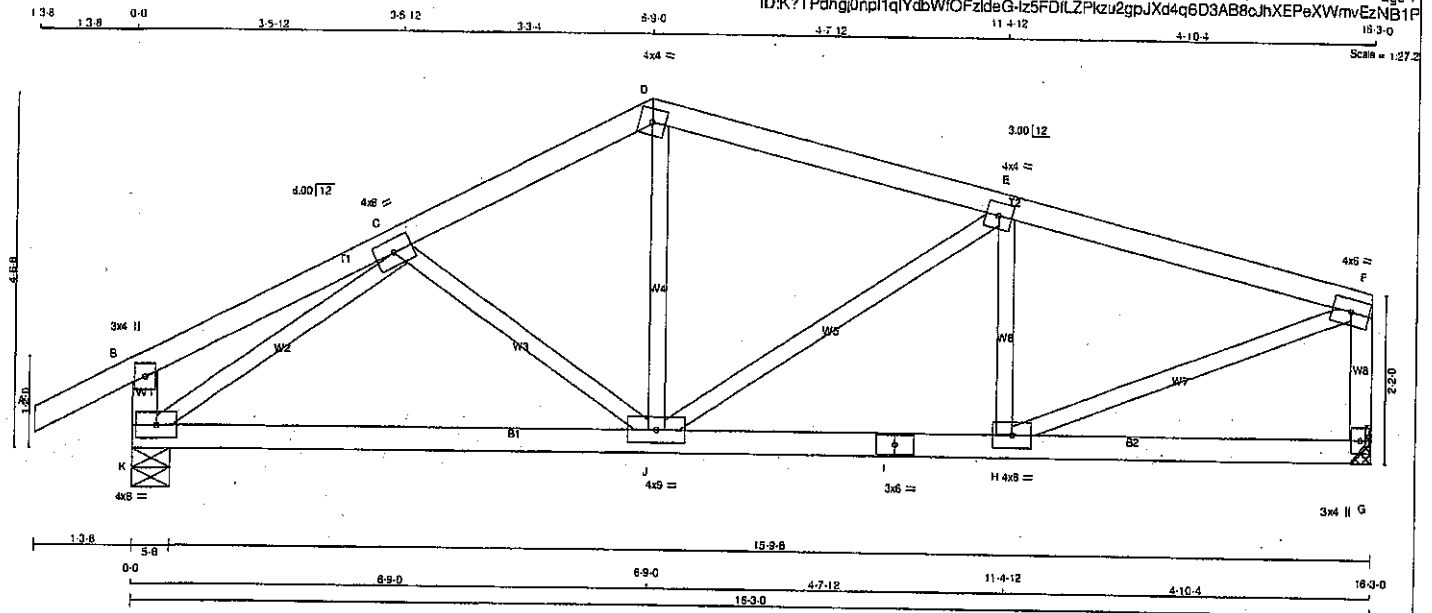

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
K - B	2x4	DRY	No.2
G - F	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY, SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV-p	MT20	3.0	4.0	
C	TMVW-t	MT20	4.0	6.0	
D	TTW-J	MT20	4.0	4.0	
E	TMVW-t	MT20	4.0	4.0	
F	TMVW-t	MT20	4.0	6.0	
G	BMV1-p	MT20	3.0	4.0	
H	BMVW-t	MT20	4.0	6.0	
I	BS-t	MT20	3.0	6.0	
J	BMVW-t	MT20	4.0	6.0	
K	BMVW-t	MT20	4.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS	REACTION	GROSS	REACTION	BRG	BRG	IN-SX	IN-SX
K	1020	0	1020	0	0	5-8	5-8		
G	886	0	886	0	0	MECHANICAL			

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3'-8."

UNFACTORED REACTIONS

1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	719	485/0	0/0	0/0	0/0	234/0	0/0
G	633	416/0	0/0	0/0	0/0	218/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.73 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0/28	-91.8	-91.8 0.12 (1)	10.00	C-J	-135/7	0.04 (1)
B-C	0/14	-91.8	-91.8 0.15 (1)	10.00	J-D	0/355	0.08 (1)
C-D	-962/0	-91.8	-91.8 0.13 (1)	6.20	J-E	-263/0	0.13 (1)
D-E	-634/0	-91.8	-91.8 0.28 (1)	6.18	H-E	-335/0	0.07 (1)
E-F	-1034/0	-91.8	-91.8 0.27 (1)	5.73	K-C	-1195/0	0.35 (1)
K-B	-248/0	0.0	0.0 0.03 (1)	7.81	H-F	0/1150	0.28 (1)
G-F	-855/0	0.0	0.0 0.10 (1)	7.81			
K-J	0/956	-18.5	-18.5 0.28 (1)	10.00			
J-I	0/1073	-18.5	-18.5 0.27 (1)	10.00			
I-H	0/1073	-18.5	-18.5 0.27 (1)	10.00			
H-G	0/0	-18.5	-18.5 0.10 (4)	10.00			

TOTAL WEIGHT = 2 X G3 = 126 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSK: TC=0.277/1.00 (E-F:1), BC=0.277/1.00 (H-J:1), WB=0.35/1.00 (C-K:1), SS=0.21/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.71 (H) (INPUT = 0.90)
JSI METAL= 0.32 (I) (INPUT = 1.00)

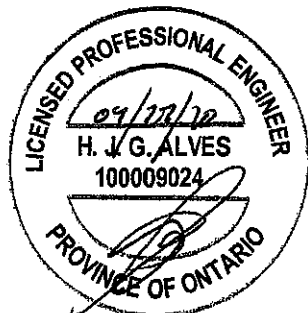

Structural component only
DWG# T-2007179

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:29 2020 Page 1
ID:K?TPdhgJ0npIqYdbWfOFzIdeG-D9fdR?MBA25lfOV4Kb3ePbKcYx2QzGGZlBfKSgzN81C

Sale = 1/20.0

LUMBER	N. L. G. A. RULES	CHORDS SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
G - H	2x4	DRY	No.2	SPF	
I - J	2x4	DRY	No.2	SPF	
K - L	2x4	DRY	No.2	SPF	
M - N	2x4	DRY	No.2	SPF	
O - P	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	EXCEPT	

DRY: SEASONED LUMBER.

DESIGN CRITERIA

SPECIFIED LOADS:

- TOP CH. LL = 25.6 PSF
- DL = 8.0 PSF
- BOT CH. LL = 0.0 PSF
- DL = 7.4 PSF
- TOTAL LOAD = 39.0 PSF

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018 , OBC 2012 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 085-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.54")

CALCULATED VERT. DEFL.(LL) = L / 899 (0.02")

ALLOWABLE DEFL.(TL)= L/360 (0.64")

CALCULATED VERT. DEFL.(TL) = L / 999 (0.12")

CSI: TC=0.35/1.00 (F-G:1), BC=0.30/1.00 (H-K:4), WB=0.43/1.00 (C-K:1), SS=0.19/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MIN MAX MIN MAX MIN		
MT20	518 354 1667 788 1987 1656	

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.66 (C) (INPUT = 0.90)
JSI METAL= 0.40 (C) (INPUT = 1.00)

STRUCTURAL COMPONENT ONLY
DWG# T-2007180

LICENSED PROFESSIONAL ENGINEER
H. J. G. ALVES
100009024
PROVINCE OF ONTARIO




Structural component only
DWG# T-2007180

JOB NAME 408170	TRUSS NAME G52	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 13:02:13 2020 Page 1
ID:K?TPdngi0nplqIYdbWfQFzdeG-h4ha4W99x740lMAQ9zJJ?3xf05YgpiCBiNutzNB1e

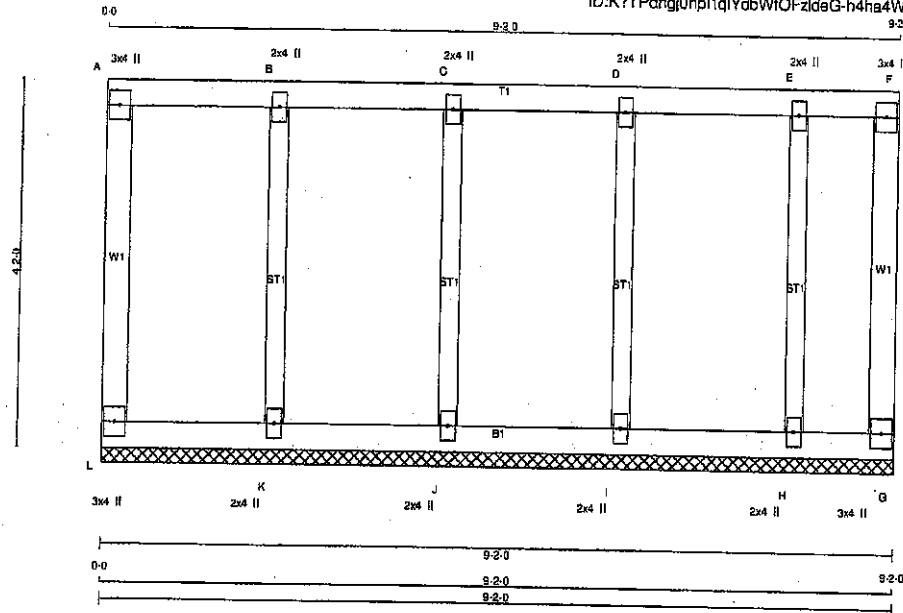

LUMBER	SIZE	LUMBER
N. L. G. A. RULES		
CHORDS	2x4	No.2
L - A	2x4	DRY
A - F	2x4	DRY
G - F	2x4	DRY
L - G	2x4	DRY

ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2'-0" O.C.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B, C, D, E						
B	TMV+w	MT20	2.0	4.0		
F	TMV+p	MT20	3.0	4.0		
G	BMV1+p	MT20	3.0	4.0		
H, I, J, K						
H	BMV1+w	MT20	2.0	4.0		
L	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
L-A	-100 / 0	0.0	0.0	0.02 (1)	7.81	K-B	-245 / 0
A-B	-4 / 0	-114.3	-114.3	0.08 (1)	10.00	J-C	-224 / 0
B-C	-4 / 0	-114.3	-114.3	0.08 (1)	10.00	I-D	-238 / 0
C-D	-4 / 0	-114.3	-114.3	0.07 (1)	10.00	H-E	-186 / 0
D-E	-4 / 0	-114.3	-114.3	0.07 (1)	10.00		
E-F	-4 / 0	-114.3	-114.3	0.05 (1)	10.00		
G-F	-54 / 0	0.0	0.0	0.02 (1)	7.81		
L-K	0 / 4	-18.5	-18.5	0.02 (4)	10.00		
K-J	0 / 4	-18.5	-18.5	0.02 (4)	10.00		
J-I	0 / 4	-18.5	-18.5	0.02 (4)	10.00		
I-H	0 / 4	-18.5	-18.5	0.02 (4)	10.00		
H-G	0 / 4	-18.5	-18.5	0.01 (4)	10.00		

TOTAL WEIGHT = 41 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 15.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 48.0	PSF

SPACING = 24.0 IN. G.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSF: TC=0.08/1.00 (B-C:1), BC=0.02/1.00 (J-K:4), WB=0.09/1.00 (B-K:1), SSI=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	618	354	1697

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)
JSI METAL = 0.07 (K) (INPUT = 1.00)




Structural component only
DWG# T-2007166

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T53S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:30 2020 Page 1
ID:K7TPdHgJ0npl1qYdbWOFzIdG-hLC0eLNpxLDcHzze26IBe8YnyLF9WNI5r?1_7zNB1N

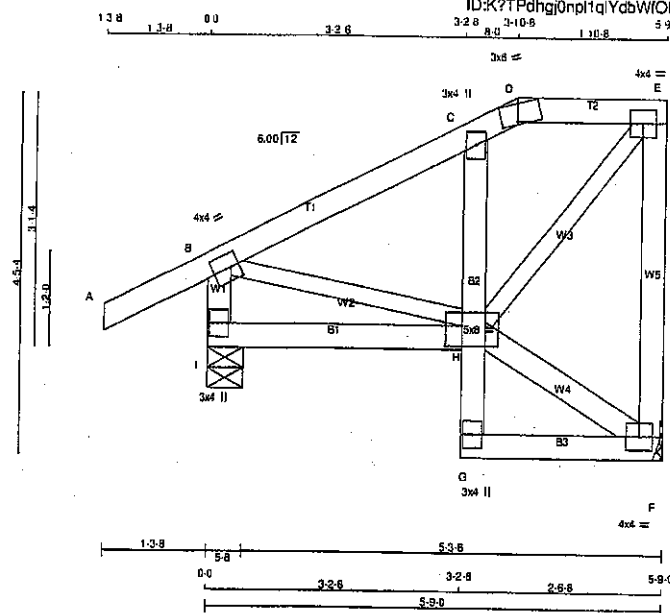

Scale = 1/25.0

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
I - B	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
G - C	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
ALL WEBS	2x4	DRY	No.2	SPF	
EXCEPT					
B - H	2x3	DRY	No.2	SPF	
H - E	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-I	MT20	4.0	4.0	2.00	1.25
C	TMVW-p	MT20	3.0	4.0		
D	TT-m	MT20	3.0	8.0	0.50	2.50
E	TMVW-I	MT20	4.0	4.0		
F	BMVW-I	MT20	4.0	4.0		
G	BMVW-p	MT20	3.0	4.0		
H	BMVW-W-I	MT20	5.0	8.0	3.00	2.50
I	BMVW-I-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS								
FACTORED			MAXIMUM FACTORED			INPUT	RECORD	
GROSS REACTION			GROSS REACTION			BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
F	302	0	302	0	0	MECHANICAL		
I	457	0	457	0	0	5-8	5-8	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-0.

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN	COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	214	138 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	75 / 0	0 / 0
I	320	225 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	95 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	LC1	MAX	CS1 (LC)	UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX
FR-TO		FROM	TO				FR-TO		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	H-F	-10 / 0	0.03 (1)	
B-C	-217 / 0	-91.8	-91.8	0.14 (1)	6.25	B-H	0 / 153	0.03 (1)	
C-D	-200 / 0	-91.8	-91.8	0.05 (1)	6.25	H-E	0 / 247	0.06 (1)	
D-E	-167 / 0	-91.8	-91.8	0.03 (1)	6.25				
E-F	-273 / 0	0.0	0.0	0.03 (1)	7.81				
F-B	-420 / 0	0.0	0.0	0.04 (4)	10.00				
I-H	0 / 41	-18.5	-18.5	0.05 (4)	10.00				
G-H	0 / 25	0.0	0.0	0.02 (1)	10.00				
H-C	-185 / 0	0.0	0.0	0.04 (1)	7.81				
G-F	0 / 18	-18.5	-18.5	0.02 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/959 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/959 (0.00")

CSI: TC=0.14/1.00 (B-C:1), BC=0.05/1.00 (H-I:4), WB=0.05/1.00 (E-H:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.38 (H) (INPUT = 0.90)


JSI METAL= 0.13 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007181

Structural component only
DWG# T-2007182

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T55	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

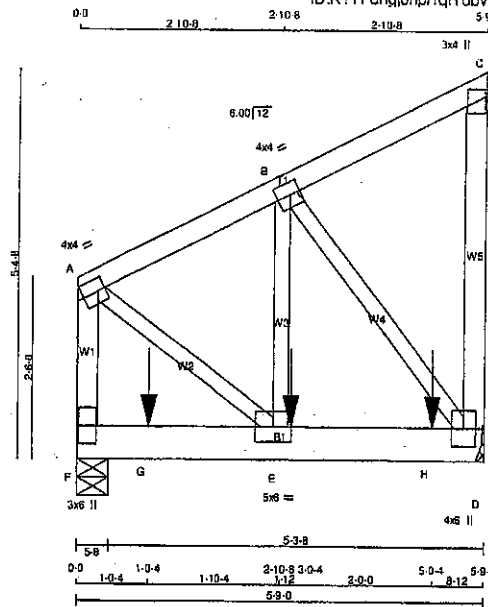

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - A	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	
F - D	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER:					

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F - A	12	TOP
A - C	12	TOP
C - D	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
B - E	6	SIDE(45.8)
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	4.0	4.0	2.00	1.25
B	TMVW-1	MT20	4.0	4.0	2.00	1.75
C	TMV+p	MT20	3.0	4.0		
D	BMVW1+p	MT20	4.0	6.0		
E	BMVW-1	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
JT	VERT	HORZ	DOWN	HORZ
F	1589	0	1589	0
D	1680	0	1680	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS
F	1121	750 / 0	0 / 0
D	1185	792 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
MEMB.				
FR-TO				
F-A	-1074 / 8	0.0	0.0	0.07 (1)
A-B	-867 / 0	-91.8	-91.8	0.06 (1)
B-C	-12 / 0	-91.8	-91.8	0.06 (1)
D-C	-105 / 0	0.0	0.0	0.02 (1)
F-G	0 / 0	-18.5	-18.5	0.19 (1)
G-E	0 / 0	-18.5	-18.5	0.19 (1)
E-H	0 / 786	-18.5	-18.5	0.21 (1)
H-D	0 / 786	-18.5	-18.5	0.21 (1)

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	3-0-4	-877	-877		BACK	VERT	TOTAL		C1
G	1-0-4	-877	-877		BACK	VERT	TOTAL		C1
H	5-0-4	-880	-880		BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 34 = 67 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NSCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.01")

CSI: TC=0.07/1.00 (A-F:1), BC=0.21/1.00 (D-E:1), WB=0.21/1.00 (B-D:1), SSI=0.20/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	518 354	1697 788
		1887 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.72 (A) (INPUT = 0.90)
JSI METAL = 0.18 (D) (INPUT = 1.00)



Structural component only
DWG# T-20071831/2


CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T55	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:32 2020 Page 2
ID:K?TPdhaQ0nol1qIYdwWOFzideG-dkKm3003SzTJWH74mT9mG3DvHI 9dNX?Z9U 2?zNB1L

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
F	BMV1+p	MT20	3.0	6.0		

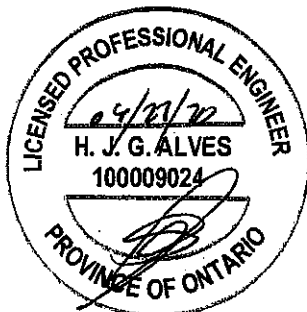


Structural component only
DWG# T-2007183

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T56	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:33 2020 Page 1
ID:K?TPdhqj0npl1qYdbWFOFzIdcG-6wu8GMPiDGBABRiGJAg?pHm499FsMnS8opDXbRzNB1K

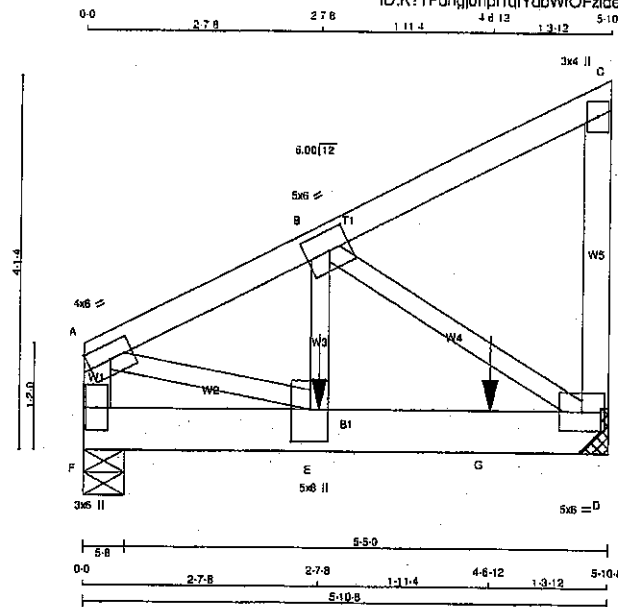

Scale = 1/25.3

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - A	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	
F - D	2x8	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F - A	12	TOP
A - C	12	TOP
C - D	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D	5	SIDE(549.3)
WEBS : (0.122"x3") SPIRAL NAILS		
B - E	2	SIDE(259.5)
2x3	5	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	4.0	8.0		Edge
B	TMVW-t	MT20	5.0	6.0	2.50	2.75
C	TMVW-p	MT20	3.0	4.0		
D	BMVW-t	MT20	5.0	6.0		
E	BMVW-t	MT20	5.0	8.0	4.25	2.50

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
F	2934	0	2934	0	0	5-8	5-8
D	2733	0	2733	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	1648	1103 / 0	0 / 0	0 / 0	0 / 0	543 / 0	0 / 0	0 / 0
D	1929	1290 / 0	0 / 0	0 / 0	0 / 0	639 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			WEBS					
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO			FR-TO			
F-A	-2316 / 0	0.0	0.0	0.13 (1)	7.37	A-E	0 / 2898 0.38 (1)	
A-B	-3101 / 0	-91.8	-91.8	0.08 (1)	5.20	E-B	0 / 2880 0.38 (1)	
B-C	-5 / 0	-91.8	-91.8	0.08 (1)	10.00	B-D	-3303 / 0 0.42 (1)	
D-C	-138 / 0	0.0	0.0	0.02 (1)	7.81			
F-E	0 / 0	-18.5	-18.5	0.01 (4)	10.00			
E-G	0 / 2779	-18.5	-18.5	0.57 (1)	10.00			
G-D	0 / 2779	-18.5	-18.5	0.57 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	2-7-8	-3101	-3101	---	BACK	VERT	TOTAL	---	C1
G	4-8-12	-1318	-1318	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 29 = 57 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.13/1.00 (A-F:1), BC=0.57/1.00 (D-E:1),
WB=0.42/1.00 (B-D:1), SS=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
		788	1987
		1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (E) (INPUT = 0.90)
JSI METAL= 0.50 (E) (INPUT = 1.00)

CONTINUED ON PAGE 2



Structural component only
DWG# T-2007184 1/2

JOB NAME 408170	TRUSS NAME T56	QUANTITY 1	PLY. 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	-----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 13:02:33 2020 Page 2
ID:K?TPdHg0nol1gYdbWIOFzIdG-6wu8GMPiDGbABRiGJAq?oHm499FsMnS8opDXbRzNB1K

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
F	BMV1+p	MT20	3.0	6.0		



Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2007184 3/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	PB1	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 26 12:34:46 2020 Page 1
ID:DMCubINVR6TstF0e31v6I_zns11-PDfyPME2p5aifFmuAaG4kD6hBP9Gw7nTyvpaZzNBRN

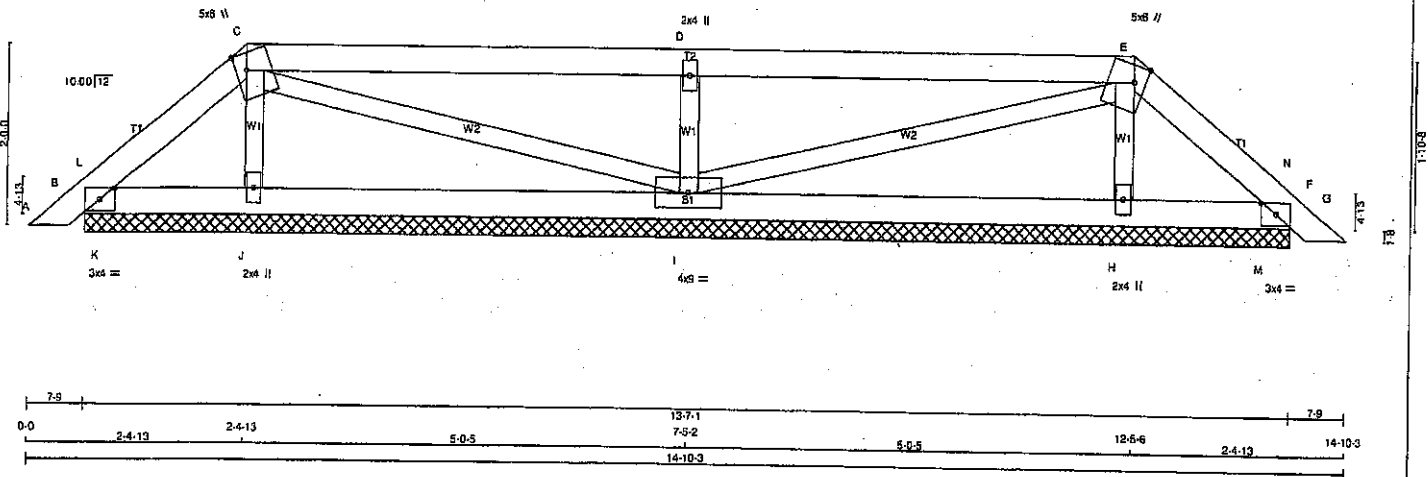

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
B - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
SPF DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	1.50	2.00
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TMW+w	MT20	2.0	4.0		
E	TTWW+m	MT20	5.0	6.0	2.25	1.50
F	TMB1-I	MT20	3.0	4.0	1.50	2.00
G	BMW1+w	MT20	2.0	4.0		
H	BMW1+w	MT20	2.0	4.0		
I	BMW1+w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED		MAXIMUM FACTORED		INPUT		REQD	
	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
JT	VERT	HORZ	VERT	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX
B	169	0	169	0	0	13-7-1	13-7-1	
F	169	0	169	0	0	13-7-1	13-7-1	
J	288	0	288	0	0	13-7-1	13-7-1	
I	683	0	683	0	0	13-7-1	13-7-1	
H	288	0	288	0	0	13-7-1	13-7-1	

UNFACTORED REACTIONS

JT	1ST CASE	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
B	116	93 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0
F	116	93 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0
J	207	118 / 0	0 / 0	0 / 0	0 / 0	89 / 0	0 / 0
I	481	327 / 0	0 / 0	0 / 0	0 / 0	154 / 0	0 / 0
H	207	118 / 0	0 / 0	0 / 0	0 / 0	89 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F, J, I, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 14	-91.8 -91.8 0.02 (1)	10.00	J-C	-194 / 0	0.03 (1)	
B-L	-31 / 4	-91.8 -91.8 0.01 (1)	6.25	C-I	-22 / 0	0.01 (1)	
L-C	-60 / 0	-91.8 -91.8 0.03 (1)	6.25	I-D	-576 / 0	0.08 (1)	
C-D	-8 / 0	-91.8 -91.8 0.39 (1)	10.00	D-E	-22 / 0	0.01 (1)	
D-E	-8 / 0	-91.8 -91.8 0.39 (1)	10.00	E-H	-194 / 0	0.03 (1)	
E-N	-60 / 0	-91.8 -91.8 0.03 (1)	6.25	H-L	-121 / 0	0.00 (1)	
N-F	-31 / 4	-91.8 -91.8 0.01 (1)	6.25	M-N	-121 / 0	0.00 (1)	
F-G	0 / 14	-91.8 -91.8 0.02 (1)	10.00				
B-K	0 / 42	-18.5 -18.5 0.04 (1)	10.00				
K-J	0 / 42	-18.5 -18.5 0.07 (4)	10.00				
J-I	0 / 29	-18.5 -18.5 0.10 (4)	10.00				
I-H	0 / 29	-18.5 -18.5 0.10 (4)	10.00				
H-M	0 / 42	-18.5 -18.5 0.07 (4)	10.00				
M-F	0 / 42	-18.5 -18.5 0.04 (1)	10.00				

TOTAL WEIGHT = 3 X 45 = 135 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.39/1.00 (C-D:1), BC=0.10/1.00 (H-I:4), WB=0.08/1.00 (D-I:1), SS=0.22/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PS)	SECTION (PL)
MT20	618	354
	1687	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.30 (D) (INPUT = 0.90)
JSI METAL= 0.12 (D) (INPUT = 1.00)

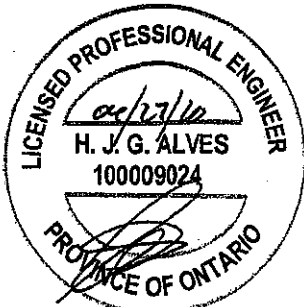


Structural component only
DWG# T-2007128

JOB NAME 408169	TRUSS NAME PB20	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 12:49:22 2020 Page 1
ID:K?TPdhgJ0npl?qYdbWIOFzIdaG-mib6FuqXVexPlkFUY_VFTVITIPkKW7jVF6AJozNB0H

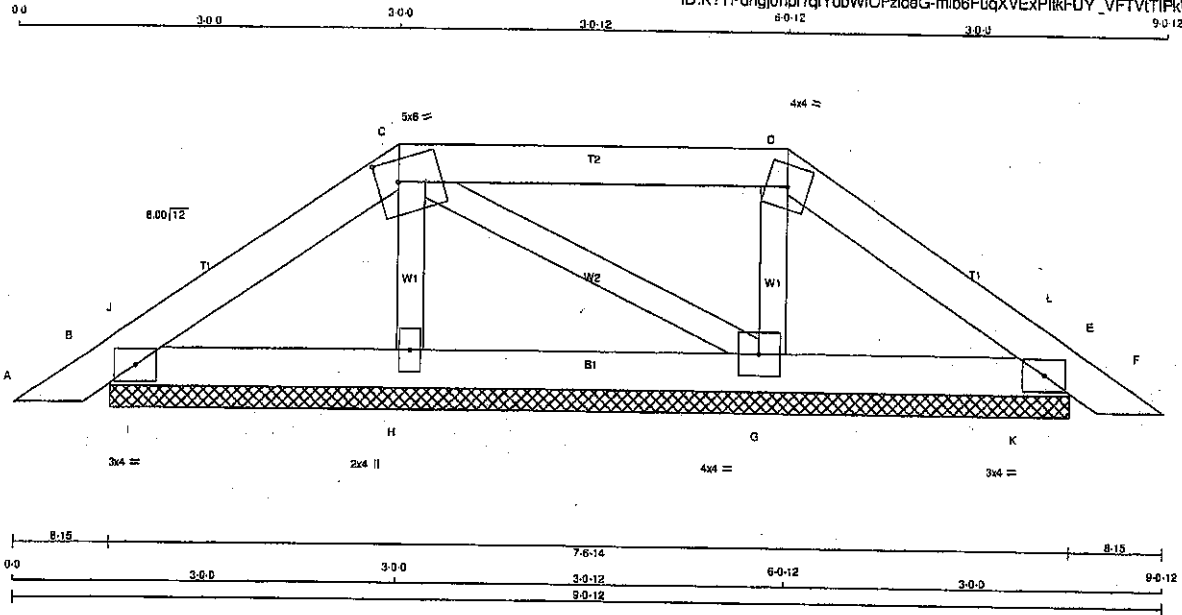

LUMBER

N. L. G. A. RULES

CHORDS SIZE

A - C 2x4 DRY

C - D 2x4 DRY

D - F 2x4 DRY

B - E 2x4 DRY

ALL WEBS 2x3 DRY

DRY: SEASONED LUMBER.

LUMBER

No.2

No.2

No.2

No.2

No.2

DESCR.

SPF

SPF

SPF

SPF

SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	UP/LIFT
B	221	0	221	0
E	209	0	209	0
H	248	0	248	0
G	280	0	280	0

UNFACTORED REACTIONS

1ST LOOSE	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	154	113 / 0	0 / 0	0 / 0	0 / 0	41 / 0	0 / 0
B	146	106 / 0	0 / 0	0 / 0	0 / 0	39 / 0	0 / 0
E	178	109 / 0	0 / 0	0 / 0	0 / 0	67 / 0	0 / 0
G	198	127 / 0	0 / 0	0 / 0	0 / 0	71 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)	MAX. FACTORED VERT. LOAD (LC4)	MAX. FACTORED VERT. LOAD (LC5)	MAX. FACTORED VERT. LOAD (LC6)	MAX. FACTORED VERT. LOAD (LC7)	MAX. FACTORED VERT. LOAD (LC8)	MAX. FACTORED VERT. LOAD (LC9)	MAX. FACTORED VERT. LOAD (LC10)
FR-TO													
A-B	0 / 15	-91.8	-91.8	0.03 (1)	10.00	H-C	-178 / 0	0.03 (1)					
B-J	-63 / 0	-91.8	-91.8	0.01 (1)	8.25	C-G	-21 / 0	0.03 (1)					
J-C	-74 / 0	-91.8	-91.8	0.05 (1)	6.25	G-D	-198 / 0	0.03 (1)					
C-D	-30 / 0	-91.8	-91.8	0.15 (1)	6.25	I-J	-121 / 0	0.03 (1)					
D-L	-54 / 0	-91.8	-91.8	0.05 (1)	6.25	K-L	-123 / 0	0.03 (1)					
L-E	-41 / 0	-91.8	-91.8	0.01 (1)	6.25								
E-F	0 / 15	-91.8	-91.8	0.03 (1)	10.00								
B-I	0 / 60	-18.5	-18.5	0.08 (1)	10.00								
I-H	0 / 60	-18.5	-18.5	0.05 (1)	10.00								
H-G	0 / 48	-18.5	-18.5	0.03 (1)	10.00								
G-K	0 / 43	-18.5	-18.5	0.05 (1)	10.00								
K-E	0 / 43	-18.5	-18.5	0.06 (1)	10.00								

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, CBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 085-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.15/1.00 (C-D:1), BC=0.06/1.00 (B-I:1), WB=0.03/1.00 (D-G:1), SS=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE-LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.18 (B) (INPUT = 0.90)
JSI METAL = 0.04 (B) (INPUT = 1.00)

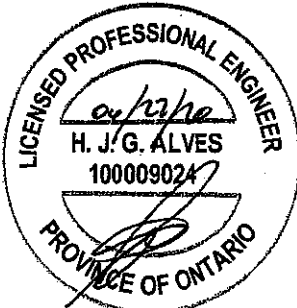


Structural component only
DWG# T-2007144

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	J1	19	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:43 2020 Page 1
ID:DMCubINVR6TstFoe31v6L_zns11-7a_pnKBAWAC7oo1JURIN76ba9zNy3aYKn_h9zEzNBRO

Scale = 1:22.9

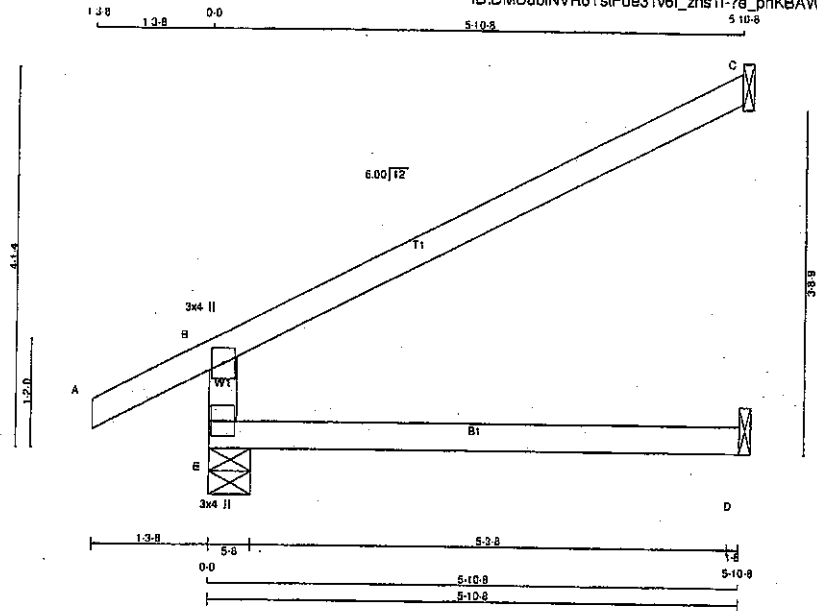

TOTAL WEIGHT = 19 X 17 = 319 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2		
A - C	2x4	DRY	No.2		
E - D	2x4	DRY	No.2		

DRY: SEASONED LUMBER.

PLATES (tablets in inches)	W	LEN	Y	X
BT TYPE	MT20	3.0	4.0	
E BTM1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
E	525	0	525	0
C	202	0	202	0
D	45	0	45	0

SEE MITEK STANDARD DETAIL B87791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	DOWN	HORZ	UP	DOWN	HORZ
E	389	257/0	0/0	0/0	111/0	0/0
C	139	113/0	0/0	0/0	26/0	0/0
D	38	0/0	0/0	0/0	38/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FORCE (LBS)	VERT. LOAD (LBS)	FACTORED	MAX. FORCE (LBS)	VERT. LOAD (LBS)	FACTORED
FR-TO	MEMB.	MAX. FORCE (LBS)	VERT. LOAD (LBS)	FACTORED	MAX. FORCE (LBS)	VERT. LOAD (LBS)	FACTORED
E-B	0/29	-481/0	0.0	0.0	0.13 (4)	7.81	
A-B	0/29	-91.8	-91.8	0.12 (1)	10.00		
B-C	-30/0	-91.8	-91.8	0.54 (1)	6.25		
E-D	0/0	-18.5	-18.5	0.13 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.8 PSF
BOT CH.	LL	= 6.0 PSF
	DL	= 0.0 PSF
	DL	= 7.4 PSF
TOTAL LOAD		= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NSCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NSCC 2015
- PART 9 OF NSCC 2015 (2015 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.54/1.00 (B-C:1), SC=0.13/1.00 (D-E:4), WB=0.00/1.00 (N/A:0), SSI=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PL)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1667 788 1987 1656	

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.19 (E) (INPUT = 0.90)
JSI METAL = 0.13 (B) (INPUT = 1.00)

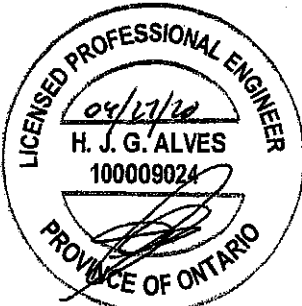


Structural component only
DWG# T-2007126

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	J2	3	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:44 2020 Page 1
ID:DMCubINVR6TstFoe31v8I_zns1I-TrY8_gCoHTK_Pxcv29DcgJ8qrNjco1oU?eQjVhzNBRP

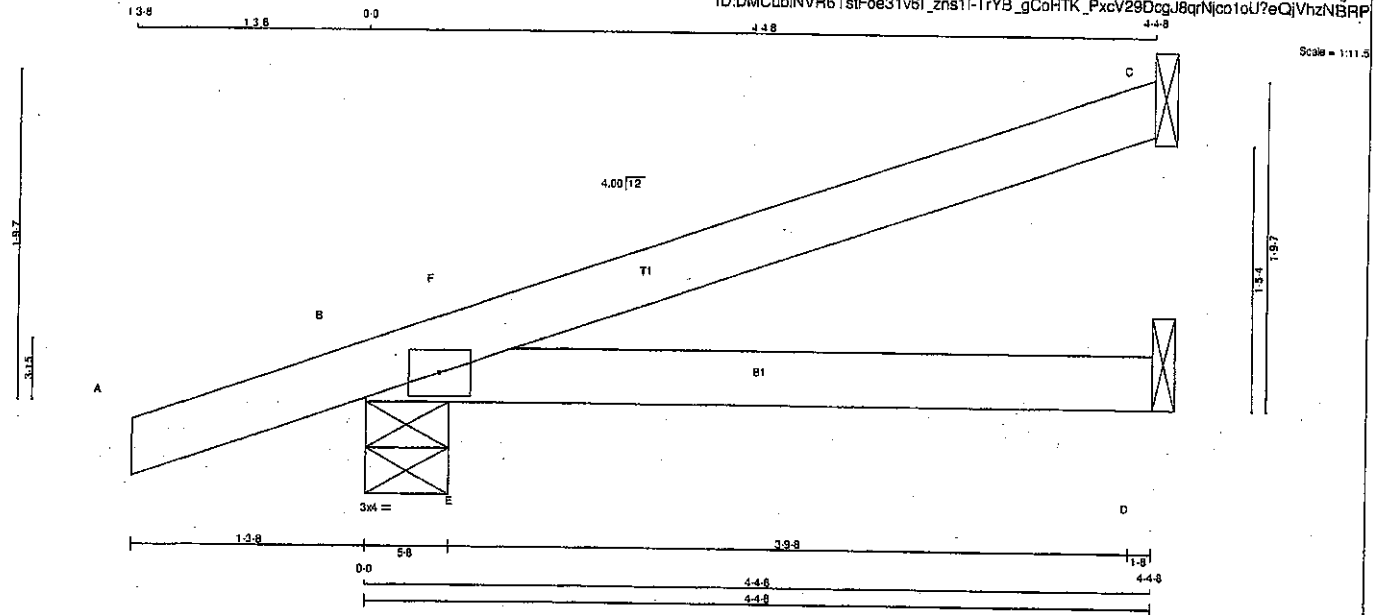

LUMBER

N. L. G. A. RULES

CHORDS SIZE

A - C 2x4 DRY No.2

B - D 2x4 DRY No.2

LUMBER

No.2

DESCR.

SPF

SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE PLATES W LEN Y X
B TMB1-I MT20 3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
C	174	0	174	0
B	364	0	364	0
D	68	0	68	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN COMPONENT REACTIONS	SNOW	LIVE	PERM LIVE	WIND	DEAD	SCIL
C	120	93/0	0/0	0/0	0/0	0/0	27/0	0/0
B	255	180/0	0/0	0/0	0/0	0/0	75/0	0/0
D	50	19/0	0/0	0/0	0/0	0/0	32/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)	MAX. FACTORED VERT. LOAD (LC4)	MAX. FACTORED VERT. LOAD (LC5)	MAX. FACTORED VERT. LOAD (LC6)
FR-TO									
A-B	0/18	-91.8	-91.8	0.11 (1)	10.00	E-F	-194.7	0.00 (1)	
B-F	-14/0	-91.8	-91.8	0.05 (4)	8.25				
F-C	0/2	-91.8	-91.8	0.22 (1)	10.00				
B-E	0/0	-18.5	-18.5	0.17 (1)	10.00				
E-D	0/0	-18.5	-18.5	0.17 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019

- PART 9 OF OBC 2012 (2019 AMENDMENT)

- CSA 085-09, CSA 086-14

- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")

CALCULATED VERT. DEFL. (LL) = L/999 (0.02")

ALLOWABLE DEFL. (TL) = L/360 (0.19")

CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSI: TC=0.22/1.00 (C-F:1), BC=0.17/1.00 (D-E:1),

WB=0.00/1.00 (E-F:1), SSI=0.10/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.24 (B) (INPUT = 0.90)

JSI METAL= 0.07 (B) (INPUT = 1.00)

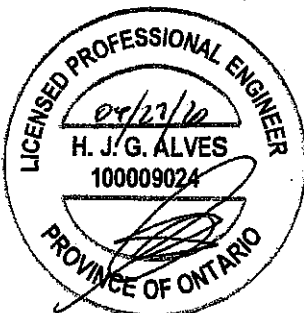

Structural component only
DWG# T-2007127


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	J20S	3	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 12:49:21 2020 Page 1
ID:K7TPdghi0npi1qYdbWIOFzideG-I21k2YpwxpY7j92wrSGiGzsv3rng3ZgbMdnLzNBDI

13.9 1.38 0.0 2.58 2.58 3.10-8

Scale = 1/2" = 1'-0"

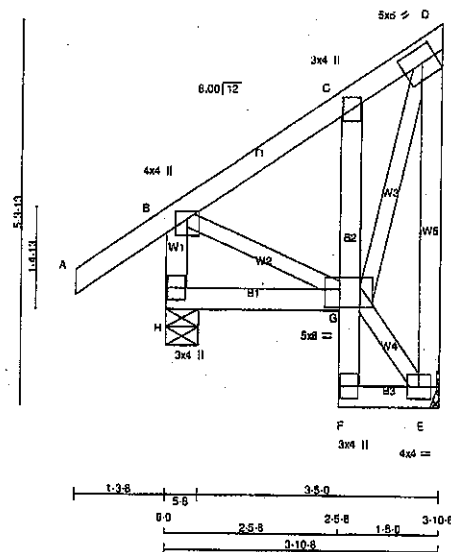

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
H - B	2x4	DRY	No.2	SPF
A - D	2x4	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF
F - C	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT E - D	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.25	2.00
C TMV+p	MT20	3.0	4.0		
D TMVW-1	MT20	5.0	8.0	2.50	2.50
E BMVW-1	MT20	4.0	4.0		
F BMV+p	MT20	3.0	4.0		
G BMVW-1	MT20	5.0	8.0	3.00	2.50
H BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	IN-SX	IN-SX
H	332	0	5-8	5-8
E	206	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
H	232	166 / 0	0 / 0	0 / 0	0 / 0	66 / 0
E	145	95 / 0	0 / 0	0 / 0	0 / 0	50 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX. CSI (LC)
FR-TO				FR-TO			
H-B	-307 / 0	0.0	0.03 (1)	B-G	0 / 83	0.02 (1)	
A-B	0 / 35	-91.8	-91.8 0.14 (5)	E-D	-184 / 0	0.05 (1)	
B-C	-83 / 0	-91.8	-91.8 0.07 (1)	G-E	-14 / 0	0.00 (1)	
C-D	-100 / 0	-91.8	-91.8 0.06 (1)	G-D	0 / 220	0.05 (1)	
H-G	0 / 0	-18.5	-18.5 0.04 (4)				
F-G	0 / 12	0.0	0.0 0.02 (1)				
G-C	-218 / 0	0.0	0.0 0.02 (1)				
F-E	0 / 9	-18.5	-18.5 0.01 (4)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 29 = 86 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT. CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (A-B-S), BC=0.04/1.00 (G-H-4), WB=0.05/1.00 (D-E-1), SS=0.09/1.00 (A-B-S)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.30)
JSI METAL = 0.07 (C) (INPUT = 1.00)

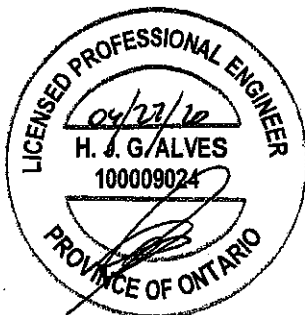


Structural component only
DWG# T-2007143

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	J40	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:14 2020 Page 1
ID:K?TPdthg0npl1qYcbWFOFzIdeG-9GFyHsAnIRCIWWbchqYYGUjVSPHGLQM61Q2zNB1c

Scale = 1:28.2

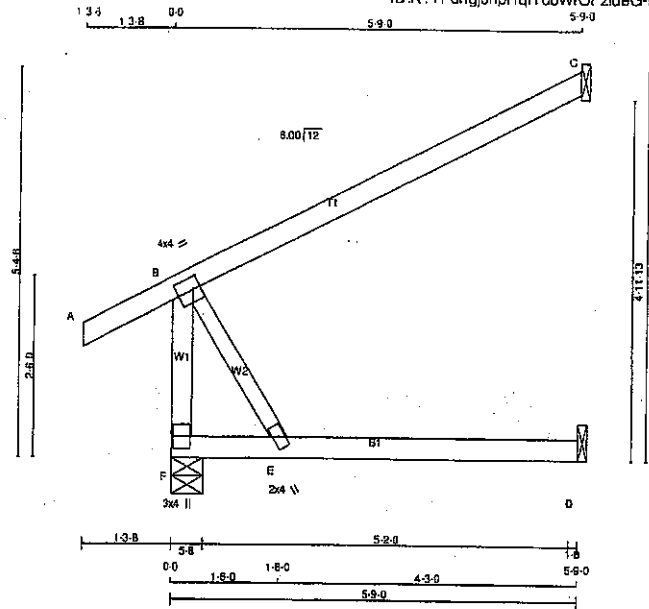

TOTAL WEIGHT = 20 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

DESCR.
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
F	441	0	441	0
C	264	0	264	0
D	53	0	53	0

SEE MITEK STANDARD DETAIL B87791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS
	COMBINED	SNOW	LIVE
F	310	217 / 0	0 / 0
C	182	147 / 0	0 / 0
D	43	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
F-B		-383 / 0	0.0	0.05 (1)	B-E		0 / 0	0.00 (1)
A-B		0 / 28	-91.8	0.12 (1)				
B-C		0 / 0	-91.8	0.52 (1)				
F-E		0 / 0	-18.5	0.14 (4)				
E-D		0 / 0	-18.5	0.18 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19')
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00')
ALLOWABLE DEFL. (TL) = $L/360$ (0.19')
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.05')

CSI: TC=0.52/1.00 (B-C:1), BC=0.18/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MT20	618	354
1657	789	1987
1656		

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (B) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007167

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	C40	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITEK Industries, Inc. Sat Apr 25 13:02:08 2020 Page 1
ID:K?TPdhgJ0npl1qYdbWfOFzideG-K7h1p606bSjebITMQj8I?Emz4pp?ZnT2QfCOzNB1

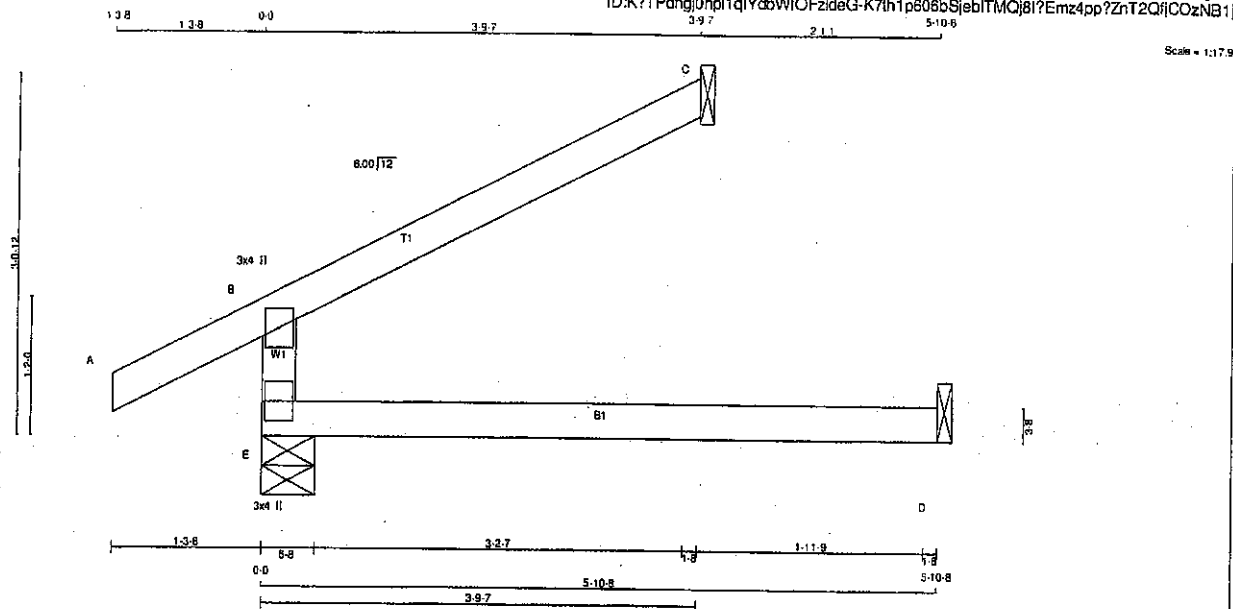

TOTAL WEIGHT = 3 X 14 = 42 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
<u>BEARINGS</u>							
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REGRD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	405	0	405	0	0	5-8	5-8
C	130	0	130	0	0	1-8	1-8
D	45	0	50	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E C D	288	180 / 0	0 / 0	0 / 0	0 / 0	86 / 0	0 / 0
	90	73 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	LC2 MAX	MEMB. FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO			FR-TO	
E-B	-342 / 0	0.0	0.0	0.13 (4)	7.81	
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	
B-C	-19 / 0	-91.8	-91.8	0.22 (1)	6.25	
E-D	0 / 0	-18.5	-18.5	0.13 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 5.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CSI: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (WAB), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLJ)	(PLJ)
MAX	MIN	MAX
MT20	518	354
	1667	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007162

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	C41	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 13:02:09 2020 Page 1
ID:K?TPdhgJ0nplqYdbWIOFzIdeG-pJR3E86etvaaGltfw7ENrDmzIU9yk01cG4PGkrzNB11

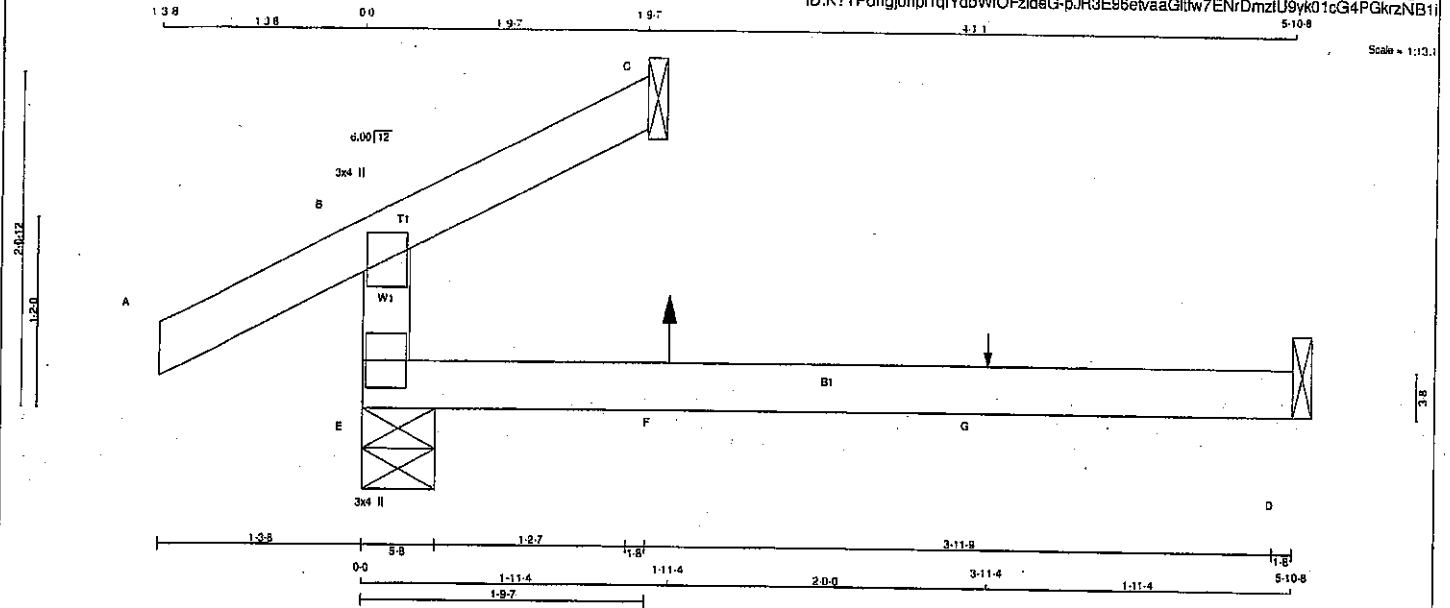

TOTAL WEIGHT = 3 X 12 = 35 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REORD BRG
	VERT	HORZ	DOWN	HORZ		
E	284	0	284	0	5-8	5-8
C	83	0	83	0	1-8	1-8
D	44	0	52	0	1-8	1-8

SEE MITEK STANDARD DETAIL B87791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	200	137 / 0	0 / 0	0 / 0	0 / 0	52 / 0	0 / 0
C	46	21 / 0	0 / 0	0 / 0	0 / 0	25 / 0	0 / 0
D	35	0 / 3	0 / 0	0 / 0	0 / 0	37 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (7)

MEMB.	CHORDS		WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PL)	MAX. CS1 (LC)	MAX. UNBRAC LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO				
E-B	-227 / 0	0.0	0.0	0.11 (4)	7.81	
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	
B-C	-9 / 9	-91.8	-91.8	0.08 (4)	10.00	
E-F	0 / 0	-18.5	-18.5	0.14 (4)	10.00	
F-G	0 / 0	-18.5	-18.5	0.14 (4)	10.00	
G-D	0 / 0	-18.5	-18.5	0.14 (4)	10.00	

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11.4	7	1	12	BACK	VERT	TOTAL	--	C1
G	3-11.4	1	1	--	BACK	VERT	TOTAL	--	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 085-14
- TPO 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (0.20")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.01")
ALLOWABLE DEFL.(TL) = 1/360 (0.20")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.04")

CS1: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4),
WB=0.09/1.00 (n/a:0), SS1=0.09/1.00 (A-B:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
	MAX MIN	MAX MIN
MT20	618 354	1687 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007163

JOB NAME:	TRUSS NAME:	QUANTITY:	PLY:	JOB DESC.:	GREEN PARK HOMES	DRWG NO.:
408170	C42	3	1	TRUSS DESC.:		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 13:02:10 2020 Page 1
ID:K?TPdngj0npt1qYdbWOFzideG-HV?SRV7G6CiuRrRrRcNCJ6SuW4TTmVh8pHhZNB1h

Scale = 1:8.2

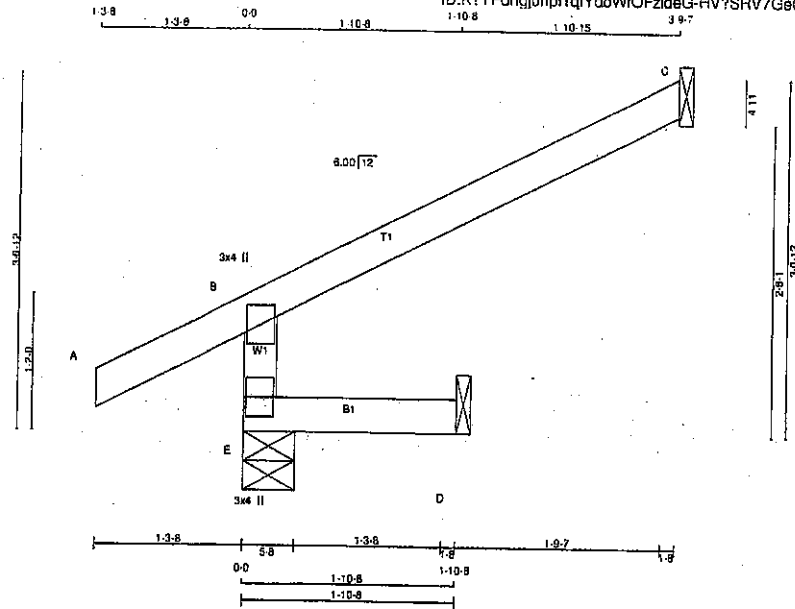

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2		SPF	
A - C	2x4	DRY	No.2		SPF	
E - D	2x4	DRY	No.2		SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0			
E	BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED		MAXIMUM FACTORED		INPUT		REQD	
	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
JT	361	0	361	0	5-8	5-8	5-8	5-8
E	130	0	130	0	1-8	1-8	1-8	1-8
C	16	0	17	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS	1ST CASE		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
JT	250	190 / 0	0 / 0	0 / 0	0 / 0	80 / 0	0 / 0
E	90	78 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	12	0 / 0	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD	FACTORED		MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
				FROM	TO				
E-B		-342 / 0	0.0	0.0	0.01 (4)	7.81			
A-B		0 / 28	-91.8	-91.8	0.13 (5)	10.00			
B-C		-19 / 0	-91.8	-91.8	0.22 (1)	6.25			
E-D		0 / 0	-18.5	-18.5	0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 10 = 29 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.09/1.00 (n/a:0), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PLI) (PSI) (PLI) (PSI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 798 1987 1686

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.14 (E) (INPUT = 0.90)
JSI METAL=0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007164

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	C43	3	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:11 2020 Page 1
ID:K?TPdngj0np1qYdbWfOFzIdeG-iIzqr8uPWqIV2011YHrwesJqls_CwXvkOuNpizNB1g

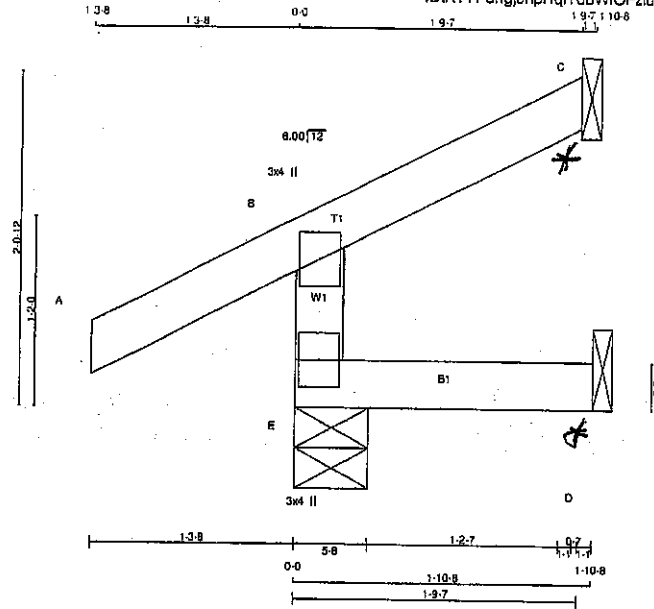

Scale = 1:13.1

TOTAL WEIGHT = 3 X 7 = 21 lb (M)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2		
A - C	2x4	DRY	No.2		
E - D	2x4	DRY	No.2		

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	9MV1+p	MT20	3.0	4.0		

DESCR.
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	DOWN	IN-SX	IN-SX
E	271	0	0	5-8
C	45	0	-23	1-8
D	8	0	-2	1-8

* SEE MITEK STANDARD DETAIL 697791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	188	141/0	0/0	0/0	0/0	47/0	0/0
C	31	24/-18	0/0	0/0	0/0	7/0	0/0
D	7	0/-8	0/0	0/0	0/0	12/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO								
E-B	-244/0	0.0	0.0	0.04 (5)	7.81			
A-B	0/29	-91.8	-91.8	0.12 (1)	10.00			
B-C	-17/0	-91.8	-91.8	0.09 (1)	8.25			
E-D	0/0	-18.5	-18.5	0.04 (5)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5),
WB=0.00/1.00 (N/A:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1867 768 1987 1856

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007165

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:

- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options Information on p. 126.




Double-Shear
Nailing
Top View




Double-Shear
Nailing
Side View;
Do not
bend tab




Dome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,580

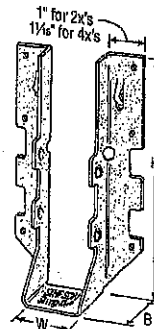


LUS26




LU26L

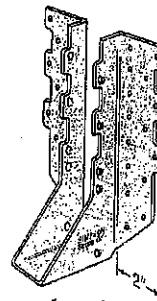


HUS210
(HUS26, HUS28,
and HHUS similar)



HGUS28-2




HHUS210-2



LJS26DS

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

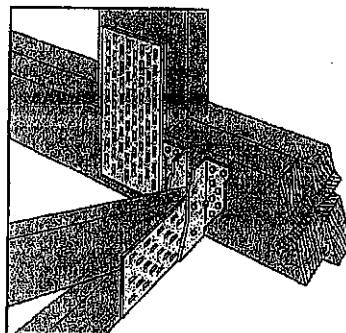

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.48 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value

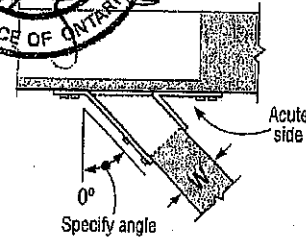

Top View HHUS Hanger
Skewed Right
(joist must be bevel cut)
All joist nails installed on the
outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance				
		W	H	B	d _g ³	Header	Joist	D.Fir-L		S-P-F		
								Uplift	Normal	Uplift	Normal	
								(K _D = 1.15) lb.	(K _D = 1.00) lb.	(K _D = 1.15) lb.	(K _D = 1.00) lb.	
Single 2x Sizes												
■	LUS24	18	1 1/8	3 1/4	1 3/4	2 1/4	(4) 10d	(2) 10d	710	1625	845	1155
									3.16	7.23	2.87	5.14
■	LU24L	22	1 1/8	3	1 1/8	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360	1020	320	725
									1.60	4.54	1.42	3.22
■	LU26L	22	1 1/8	5	1 1/8	4 5/8	(6) 10d	(4) 10d x 1 1/2"	720	1605	645	1140
									3.20	7.14	2.87	5.07
SS	LUS26	18	1 1/8	4 3/4	1 3/4	3 3/4	(4) 10d	(4) 10d	1420	2170	1290	1830
									6.32	9.65	5.74	7.25
■	HUS28	16	1 1/8	5 3/8	3	3 3/8	(14) 16d	(6) 16d	2705	4940	2065	3875
									11.30	21.97	9.20	17.24
■	LJS28DS	18	1 1/8	5	3 3/4	4 5/8	(16) 16d	(6) 16d	2055	4265	1460	4115
									9.14	18.97	6.49	18.31
■	HGUS26	12	1 1/8	5 3/8	5	4 3/8	(20) 16d	(8) 16d	2685	6625	2685	5700
									11.96	29.51	11.96	25.35
■	LU28L	20	1 1/8	6 3/4	1 1/8	5 7/8	(8) 10d	(6) 10d x 1 1/2"	1140	2185	1020	1550
									5.07	9.72	4.54	6.89
SS	LUS28	18	1 1/8	6 3/4	1 3/4	3 3/4	(6) 10d	(4) 10d	1420	2520	1290	1790
									6.32	11.21	5.74	7.96
■	HUS28	16	1 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3605	5365	2875	4345
									16.04	23.86	11.90	19.33
■	HGUS28	12	1 1/8	7 1/8	5	6 1/8	(36) 16d	(12) 16d	3310	7675	3310	6900
									14.74	34.19	14.74	30.73
■	LU210L	20	1 1/8	8	1 1/8	7 5/8	(10) 10d	(8) 10d x 1 1/2"	1140	2495	1020	1770
									5.07	11.10	4.54	7.87
SS	LUS210	18	1 1/8	7 1/8	1 3/4	3 3/4	(8) 10d	(4) 10d	1420	2785	1290	2210
									6.32	12.39	5.74	9.83

1. Factored uplift resistances have been increased 16% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _e ³	Header	Joist	D, Flr-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
								lb.	lb.	lb.	lb.
								kN	kN	kN	kN
Double 2x Sizes											
LUS24-2	18	3 1/8	3 1/8	2	1 1/2	(4) 16d	(2) 16d	835	2020	590	1435
SS LUS26-2	18	3 1/8	4 1/8	2	4	(4) 16d	(4) 16d	3.71	8.99	2.62	6.38
								1720	2595	1545	1920
								7.65	11.54	6.87	8.54
HHUS26-2	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(8) 16d	2850	7335	2065	5205
								12.68	32.63	9.20	23.15
HGUS26-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
SS LUS28-2	18	3 1/8	7	2	4	(6) 16d	(4) 16d	1720	3325	1545	2575
								7.65	14.79	6.87	11.45
HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765	8940	2675	6345
								16.75	39.77	11.90	28.22
HGUS28-2	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
SS LUS210-2	18	3 1/8	9	2	6	(8) 16d	(6) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d	4670	9660	4235	7000
								20.77	42.97	18.84	31.14
HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-3	12	4 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	4670	9670	4235	6865
								20.77	49.02	18.84	30.54
HGUS210-3	12	4 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.28
Quadruple 2x Sizes											
HGUS26-4	12	6 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-4	14	6 1/8	8 1/8	3	7 1/8	(30) 16d	(10) 16d	4670	10155	4235	7210
								20.77	45.17	18.84	32.07
HGUS210-4	12	6 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
HGUS212-4	12	6 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10645
								33.98	66.70	24.13	47.35
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80
4x Sizes											
LUS46	18	3 3/8	4 3/8	2	3 3/8	(4) 16d	(4) 16d	1720	2595	1545	1920
								7.65	11.54	6.87	8.54
HHUS46	14	3 3/8	5 1/8	3	3 3/8	(14) 16d	(6) 16d	2540	7335	2065	5205
								11.30	32.63	9.20	23.15
HGUS46	12	3 3/8	5 1/8	4	4 3/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
LUS48	18	3 3/8	6 3/8	2	3 3/8	(6) 16d	(4) 16d	1720	3325	1545	2575
								7.65	14.79	6.87	11.45
HHUS48	14	3 3/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765	8940	2675	6345
								16.75	39.77	11.90	28.22
HGUS48	12	3 3/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
LUS410	18	3 3/8	8 3/8	2	5 3/8	(8) 16d	(6) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HGUS410	12	3 3/8	9	4	8 1/8	(46) 16d	(16) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
HGUS412	12	3 3/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10645
								33.98	66.70	24.13	47.35
HGUS414	12	3 3/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80



Plated Truss Connectors

See footnotes on p. 258.

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

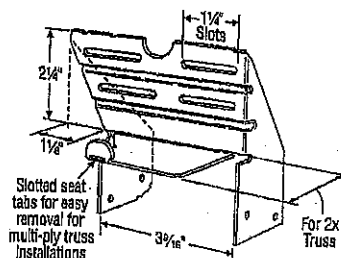


TC24
U.S. Patent 4,932,173

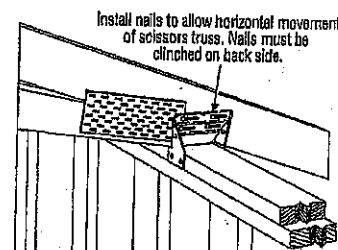


Typical TC24 Installation

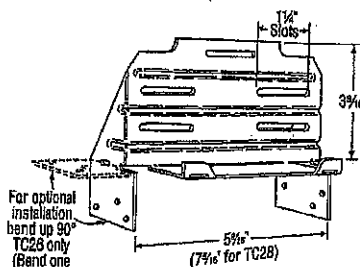

TC26
(TC28 Similar)

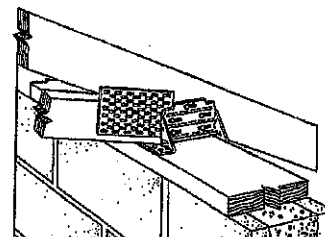

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer (8", 10", 12" Wall Installation Similar)

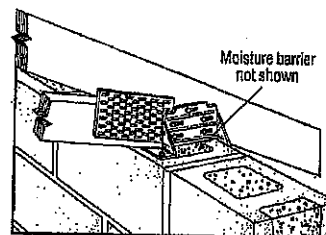


Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _u =1.15)	Uplift (K _u =1.15)
TC24	(4) 10d	(4) 10d	lb.	lb.
TC26	(5) 10d	(6) 10d	805	430
TC28	(5) 10d	(6) 10d	1015	720
			1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _u =1.15)	Uplift (K _u =1.15)
TC26	(5) 10d	(6) 10d x 1 1/2"	810	860
	(5) 10d	(6) 10d	930	860

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.
4. TC26 fastened to grouted concrete block with (6) - 3/8" x 2 1/4" Titen screws has a factored uplift resistance of 275 lb.

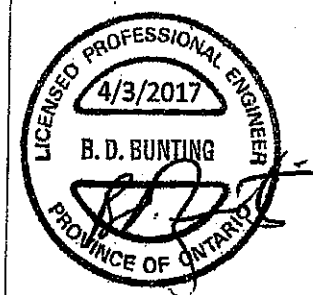

UNITED STATES DESIGN

© 2017 Simpson Strong-Tie Company
RESPECTED 3/17/2017 9/16

(800) 999-5099
strongtie.com

H/TSP**SIMPSON**
Strong-Tie**Seismic and Hurricane Ties (cont.)**

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_F = 1.15$)					
					D-Fir-L			S-P-F		
		To Rafters/ Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(6) 8d x 1½"	(4) 8d	—	740	685	300	680	485	215
					3.29	3.05	1.33	3.02	2.16	0.96
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
					3.58	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	265	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ^a	18	(5) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A ^a	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	565	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.64	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^a	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1465	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
		[2] (12) 8d x 1½"	(15) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
TSP	16	(9) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
					5.76	1.96	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.96	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D-Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D-Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D-Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.182" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry ($< 19\%$ moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

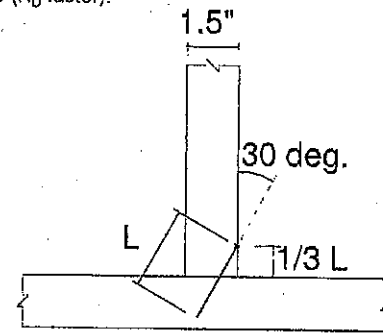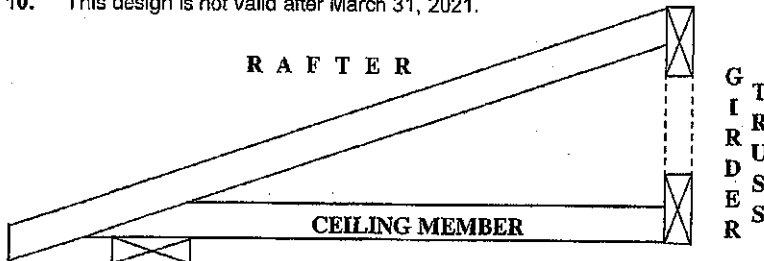


TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019

PEO
Certificate No. 10889485



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind or earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

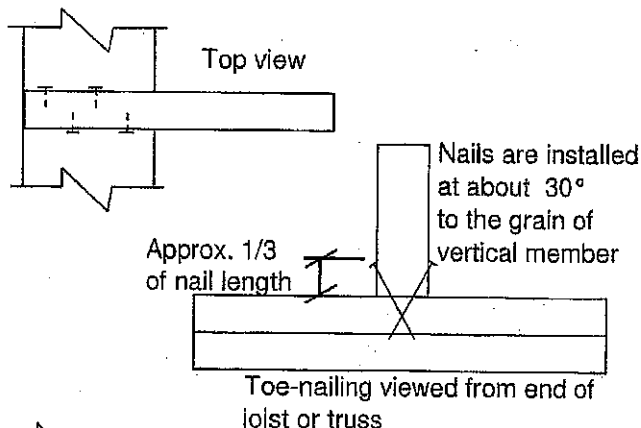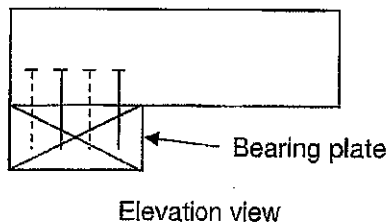

Toe-nailing on 2x4 Bearing Plate

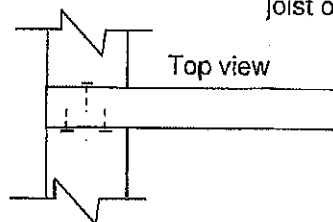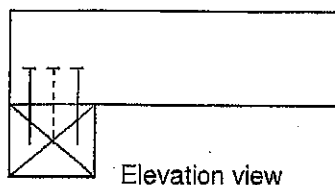

PEO
Certificate No. 10869485




MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7


December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint, unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/8" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

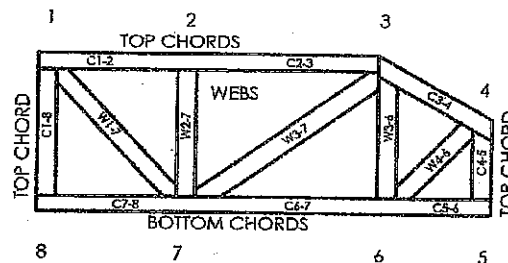

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MI-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane of joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

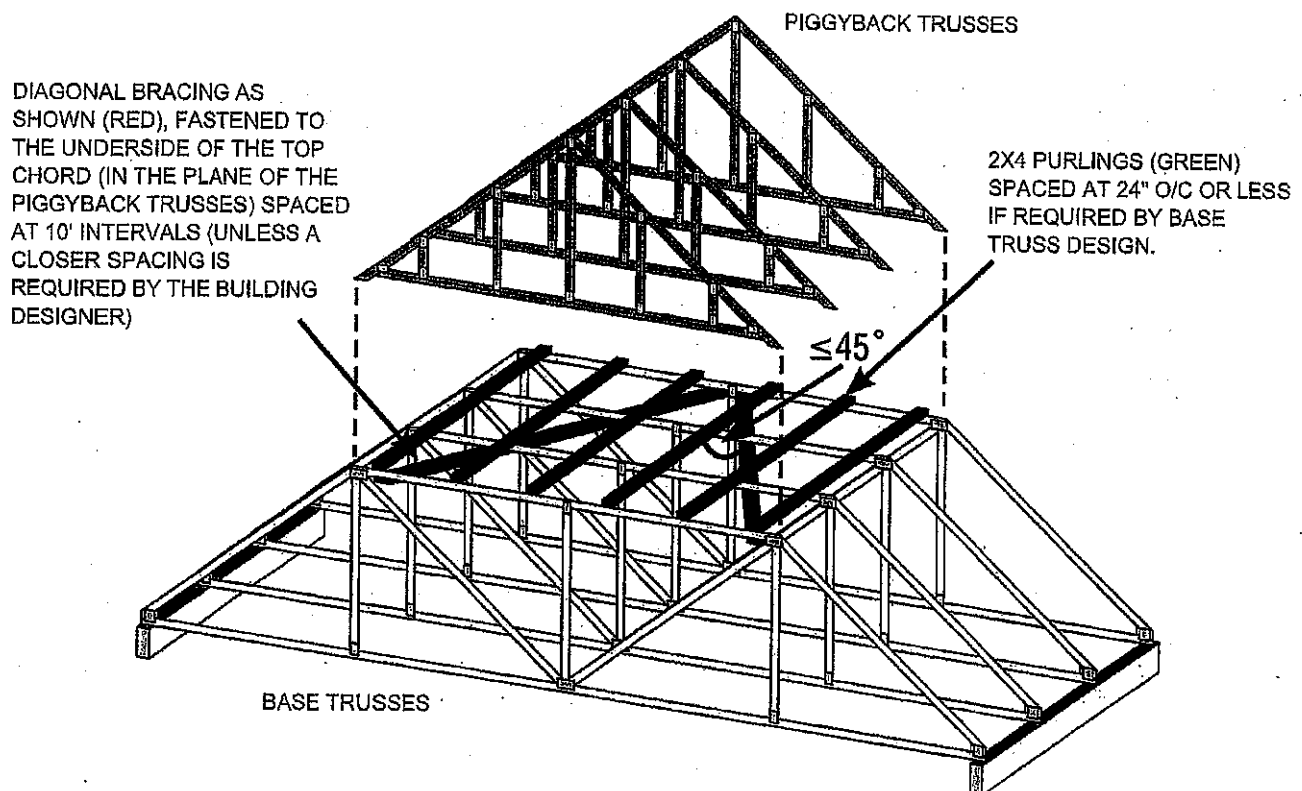

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1800215

Feb 09, 2018