

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.


All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012
(2019 amendment) OCCUPANCY:
RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
LUS26-2-(VV)

BEAMS:
B40= B41 = B42=
2 - 2x10 SPF #2

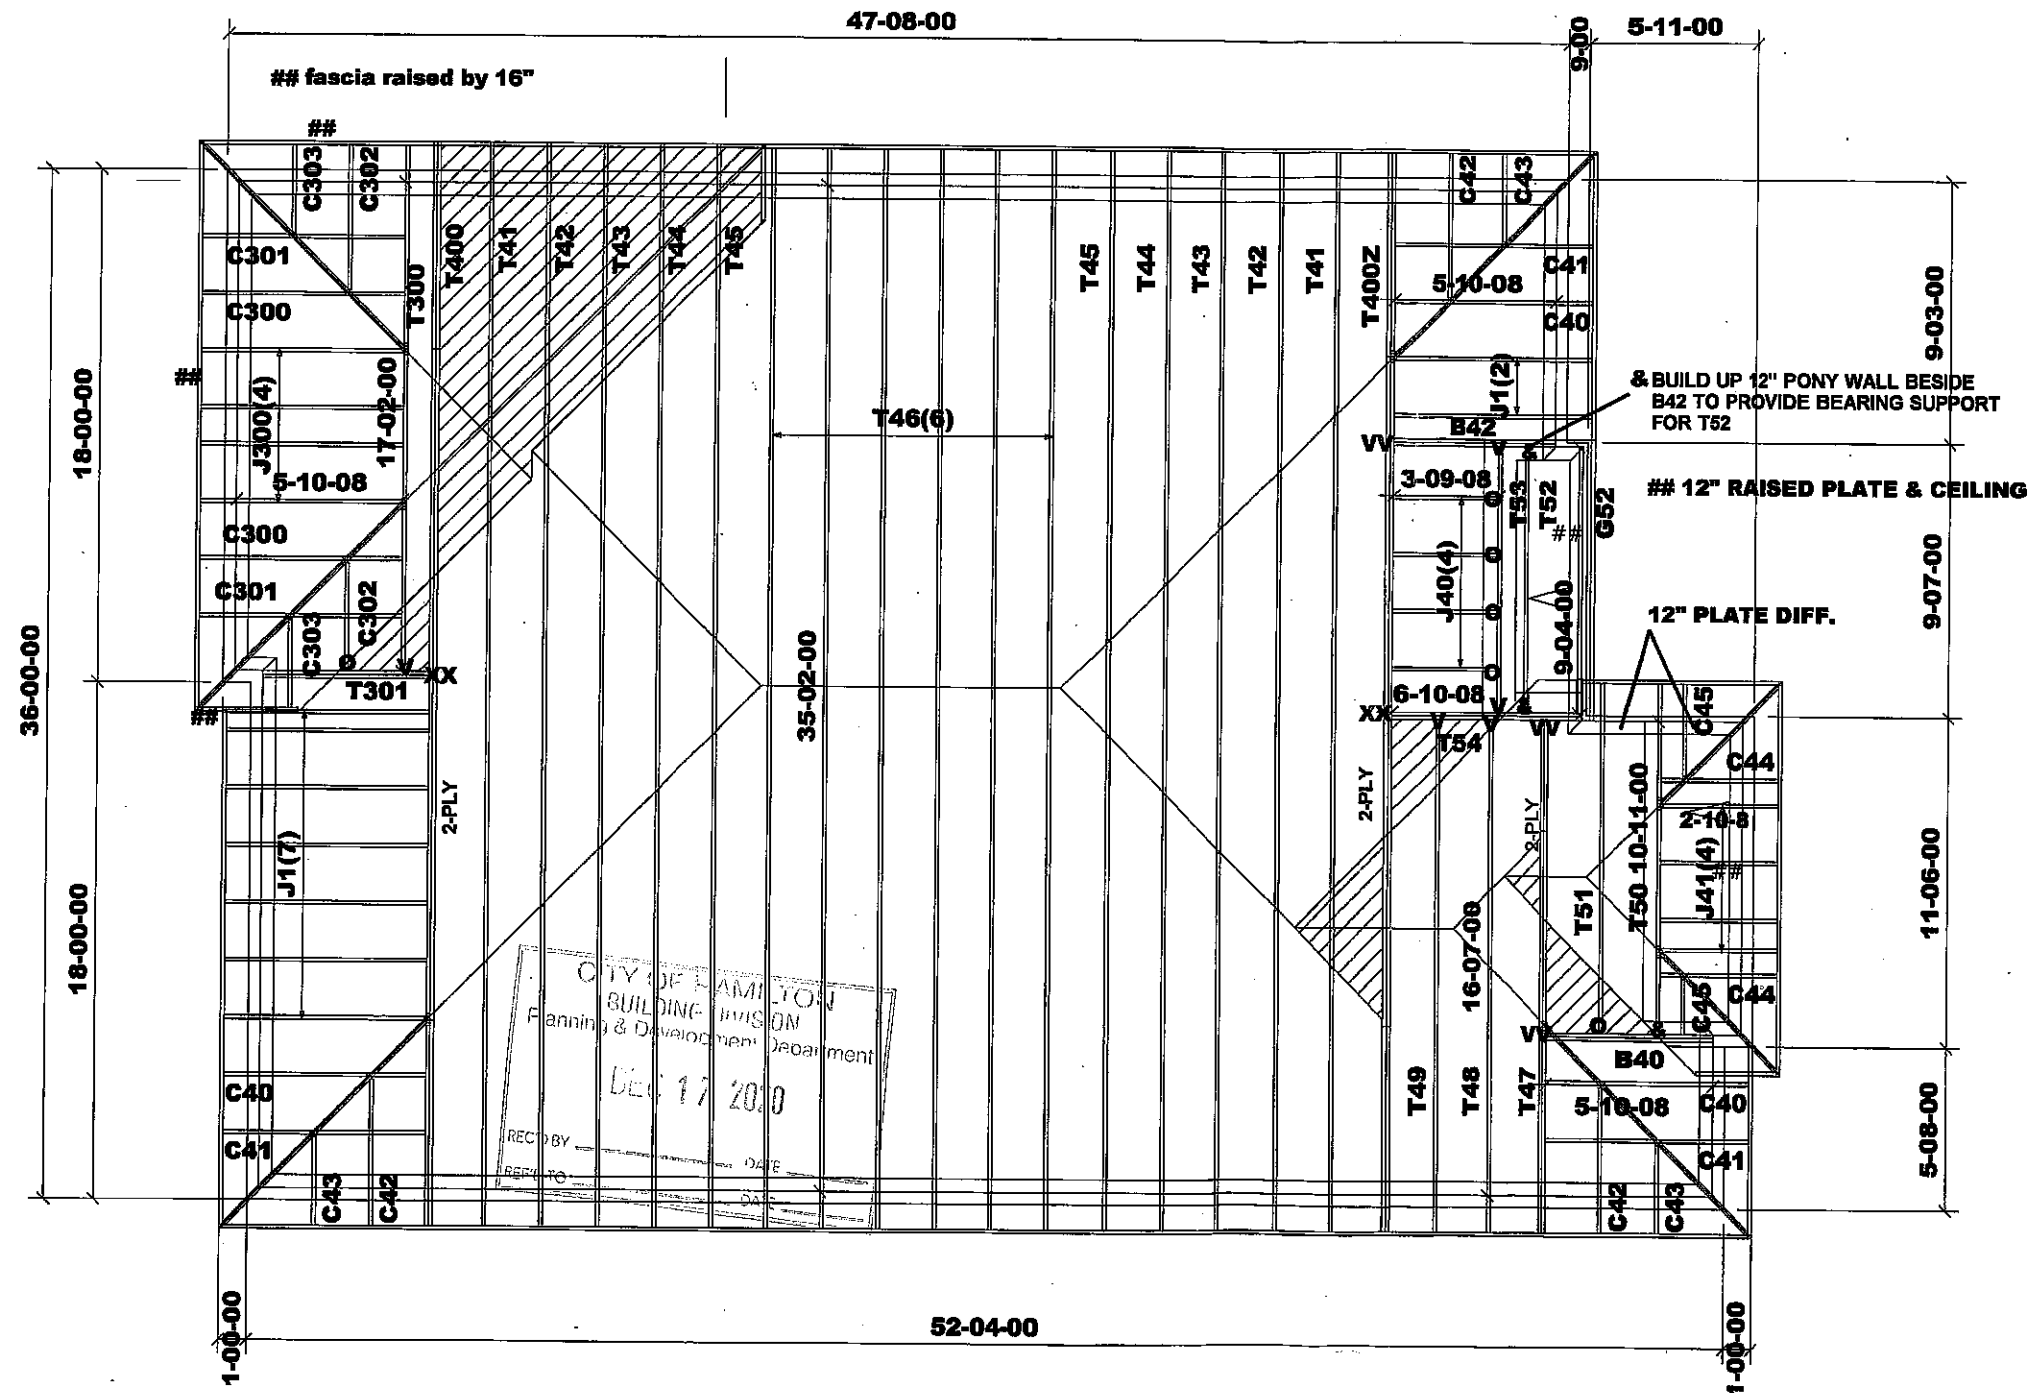 **DENOTES:
CONVENTIONAL
FRAMING**

M13125



Job Track:	51225
Plan Log:	202401
Layout ID:	412449

Builder / Location: **GREEN PARK HOMES / WATERDOWN**

Project: **RUSSELL GARDENS PH.3**

Date: 2020-09-10	Sales: Mario DiCano
------------------	---------------------

Model / Elevation:
MOUNTAINASH 4-017/3


Mitek ver 8.3.3.247

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST				Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 4-017 Lot #: Elevation: 3		Job Track: 51225 PlanLog: 202401 Layout ID: 412449 Ref # Page: 1 of 3 Date: 09-10-2020 Designer: Sales Rep: Mario DiCano	

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T41 Hip	6 /12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.99 174.00		
	2	T42 Hip	6 /12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.12 174.67		
	2	T43 Hip	6 /12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	289.07 179.67		
	2	T44 Hip	6 /12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	290.73 183.33		
	2	T45 Hip	6 /12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	301.67 191.33		
	6	T46 Common	6 /12	35-02-00	9-11-08	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	910.08 558.00		
	1 2-ply	T47 Hip Girder	6 /12	16-07-00	4-01-04	2 x 4 2 x 6	1-03-08	1-02-00 2-02-00	156.02 100.67		
	1	T48 Hip	6 /12	16-07-00	5-01-04	2 x 4	1-03-08	1-02-00 2-02-00	68.15 43.33		
	1	T49 Common	6 /12	16-07-00	5-09-12	2 x 4	1-03-08	1-02-00 2-02-00	67.14 42.33		
	1	T50 Hip Girder	6 /12	10-11-00	2-07-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	42.73 28.33		
	1	T51 Hip	6 /12	10-11-00	4-07-04	2 x 4	1-03-08 1-03-08	2-02-00 2-02-00	51.54 34.50		
	1	T52 Flat	0 /12	9-04-00	2-10-00	2 x 4		2-10-00 2-10-00	36.11 23.83		
	1	G52 GABLE	0 /12	9-04-00	2-10-00	2 x 4		2-10-00 2-10-00	33.75 23.33		
	1	T53 Flat Girder	0 /12	9-04-00	3-10-00	2 x 6		3-10-00 3-10-00	50.9 31.50		

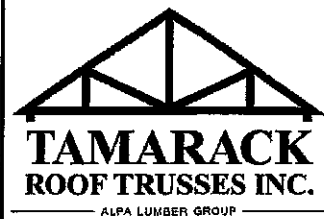

DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 4-017
 Lot #:
 Elevation: 3


Job Track: 51225
 PlanLog: 202401
 Layout ID: 412449
 Ref #
 Page: 2 of 3
 Date: 09-10-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T54 Jack-Closed Girder	6 /12	6-10-08	4-01-04	2 x 4 2 x 6		8-00 4-01-04	59.61 37.33		
	1	T300 Hip Girder	6 /12	17-02-00	5-05-04	2 x 4 2 x 6	1-03-08 1-03-08	2-06-00 2-06-00	88.18 55.00		
	1 2-ply	T301 Jack-Closed Girder	6 /12	5-10-08	4-01-04	2 x 4 2 x 6		1-02-00 4-01-04	58.39 37.67		
	1 2-ply	T400 Hip Girder	6 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	337.56 208.00		
	1 2-ply	T400Z Hip Girder	6 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	337.56 208.00		
	9	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	151.15 98.00		
	4	J40 Jack-Open	6 /12	3-09-08	4-01-04	2 x 4		2-02-08 4-01-04	52.34 35.33		
	4	J41 Jack-Open	6 /12	2-10-08	2-07-04	2 x 4	1-03-08	1-02-00 2-07-04	38.2 24.00		
	4	J300 Jack-Open	6 /12	5-10-08	5-05-04	2 x 4	1-03-08	2-06-00 5-05-04	81.15 54.00		
	3	C40 Jack-Open	6 /12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	42.4 26.00		
	3	C41 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	34.75 22.00		
	3	C42 Jack-Open	6 /12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	28.71 18.00		
	3	C43 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	21.06 14.00		
	2	C44 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 11-09	1-02-00 2-01-08	16.64 10.67		

 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP		DELIVERY SHIPLIST	
		Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 4-017 Lot #: Elevation: 3	Job Track: 51225 PlanLog: 202401 Layout ID: 412449 Ref # Page: 3 of 3 Date: 09-10-2020 Designer: Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	C45 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 1-01	1-02-00 2-01-08	14.65 9.33		
	2	C300 Jack-Open	6 /12	3-09-07	4-04-12	2 x 4	1-03-08 2-01-01	2-06-00 4-04-12	35.25 23.00		
	2	C301 Jack-Open	6 /12	1-09-07	3-04-12	2 x 4	1-03-08 4-01-01	2-06-00 3-04-12	30 20.33		
	2	C302 Jack-Open	6 /12	1-10-08	4-04-12	2 x 4	1-03-08 1-10-15	2-06-00 3-05-04	26.05 17.67		
	2	C303 Jack-Open	6 /12	1-09-07	3-04-12	2 x 4	1-03-08 1-01	2-06-00 3-04-12	20.88 15.00		

TOTAL # TRUSS= 79

TOTAL BFT OF ALL TRUSSES= 2720.15


BFT.

TOTAL WEIGHT OF ALL TRSSES 4327.53 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
2	Hardware	HGUS26-2	
5	Hardware	LJS26DS	
6	Hardware	LUS24	
3	Hardware	LUS26-2	

TOTAL NUMBER OF ITEMS= 16

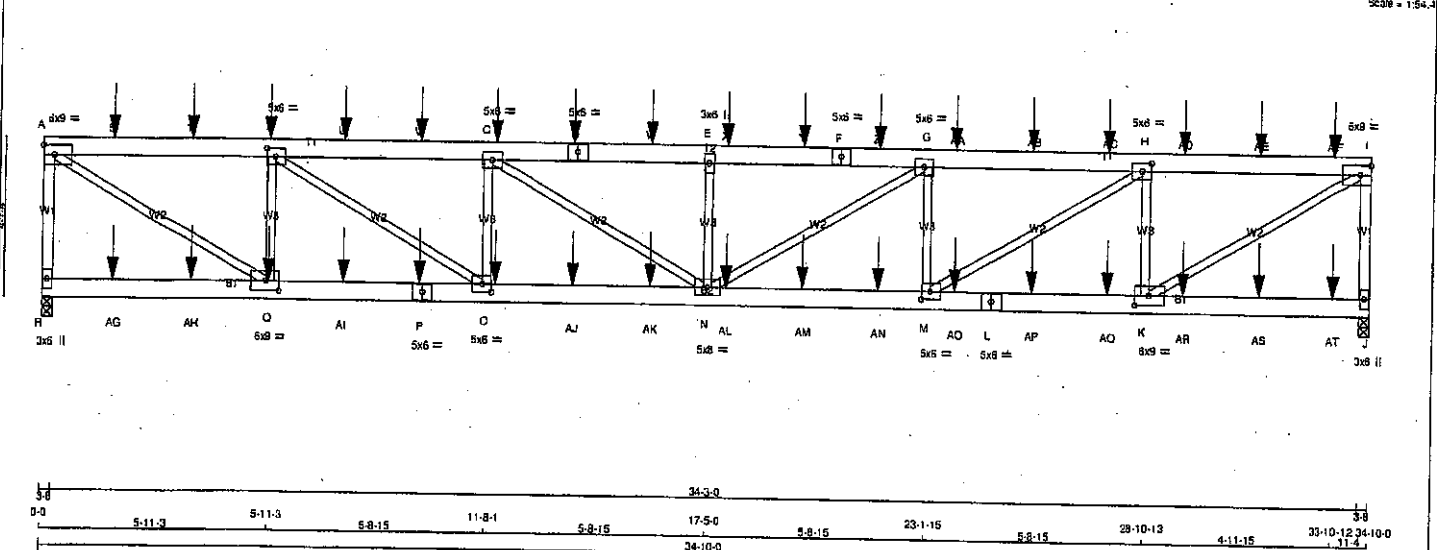

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
R - A	2x4	DRY	No.2	SPF	
A - D	2x6	DRY	No.2	SPF	
D - F	2x6	DRY	No.2	SPF	
F - I	2x6	DRY	No.2	SPF	
I - J	2x4	DRY	No.2	SPF	
J - P	2x6	DRY	No.2	SPF	
P - L	2x6	DRY	No.2	SPF	
L - J	2x6	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2
SPF
DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS	SPACING (IN)	
R - A	12	TOP
I - J	12	TOP
A - D	12	SIDE(183.1)
D - F	12	SIDE(0.0)
F - I	12	SIDE(0.0)
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
R - P	12	SIDE(183.1)
P - L	12	SIDE(183.1)
L - J	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
R	VERT	DOWN	0/0	0/0
J	HORZ	HORZ	0/0	0/0

UNFACTORED REACTIONS	1ST CASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
R	2181	1401/0
J	2209	1430/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	MAX. UNBRAC	MEMB.	FORCE
FR-TO	FROM TO	CSF (LC)	LENGTH	FR-TO	CSF (LC)
R-A	-2974/0	0.0	0.0	K-I	0/5083
A-S	-4326/0	-91.8	-91.8	A-Q	0/5078
S-T	-4326/0	-91.8	-91.8	K-H	-2465/0
T-B	-4326/0	-91.8	-91.8	Q-B	-2463/0
B-U	-6696/0	-91.8	-91.8	M-H	0/2804
U-V	-6696/0	-91.8	-91.8	B-O	0/2808
V-C	-6696/0	-91.8	-91.8	M-G	-1325/0
C-D	-7505/0	-91.8	-91.8	O-C	-1326/0
D-W	-7505/0	-91.8	-91.8	N-G	0/956
W-E	-7505/0	-91.8	-91.8	C-N	0/958
E-X	-7505/0	-91.8	-91.8	N-E	-851/0
X-Y	-7505/0	-91.8	-91.8		
Y-F	-7505/0	-91.8	-91.8		
F-Z	-7505/0	-91.8	-91.8		
Z-G	-7505/0	-91.8	-91.8		
G-AA	-6688/0	-91.8	-91.8		
AA-AB	-6688/0	-91.8	-91.8		
AB-AC	-6688/0	-91.8	-91.8		
AC-H	-4330/0	-91.8	-91.8		
H-AO	-4330/0	-91.8	-91.8		
AO-AE	-4330/0	-91.8	-91.8		
AE-AF	-4330/0	-91.8	-91.8		
AF-I	-4330/0	-91.8	-91.8		
I-J	-3028/0	0.0	0.0		

TOTAL WEIGHT = 2 X 178 = 353 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (1/16")

CALCULATED VERT. DEFL.(LL) = L/999 (0.20")

ALLOWABLE DEFL.(TL) = L/380 (1/16")

CALCULATED VERT. DEFL.(TL) = L/999 (0.38")

CSI: TC=0.35/1.00 (I-J:1), BC=0.48/1.00 (M-N:1), WB=0.69/1.00 (K-L:1), SS=0.17/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1668

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.66 (K) (INPUT = 0.90)
JSI METAL= 0.42 (F) (INPUT = 1.00)

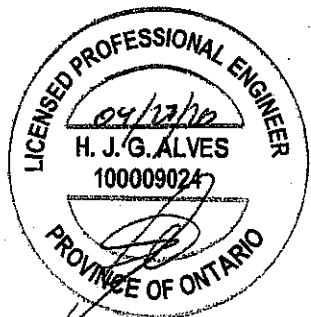

Structural component only
DWG# T-2007063

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWW-I	MT20	6.0	9.0		Edge
S	TMWW-I	MT20	5.0	6.0	2.50	2.75
C	TMWW-I	MT20	5.0	6.0		
D	TS-I	MT20	5.0	6.0		
E	TMWW-w	MT20	5.0	6.0		
F	TS-I	MT20	5.0	6.0		
G	TMWW-I	MT20	5.0	6.0		
H	TMWW-I	MT20	5.0	6.0	2.50	2.75
I	TMWW-I	MT20	6.0	9.0		Edge
J	BMV1-p	MT20	2.0	6.0		
K	BMWW-I	MT20	6.0	9.0	3.00	4.25
L	BS-I	MT20	5.0	6.0		
M	BMWW-I	MT20	5.0	6.0	2.50	2.75
N	BMWW-I	MT20	5.0	6.0		
O	BMWW-I	MT20	5.0	6.0	2.50	2.75
P	BS-I	MT20	5.0	6.0		
Q	BMWW-I	MT20	6.0	9.0	3.00	4.25
R	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX. CSI (LC)
FR-TO		FROM TO		FR-TO		FROM TO	
K-AR	0 / 0	-18.5	-18.5 0.06 (4)	10.00			
AR-AS	0 / 0	-18.5	-18.5 0.06 (4)	10.00			
AS-AT	0 / 0	-18.5	-18.5 0.06 (4)	10.00			
AT-J	0 / 0	-18.5	-18.5 0.06 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
B	5-10-12	-110	-110		FRONT	VERT	TOTAL		C1
C	11-10-12	-110	-110		FRONT	VERT	TOTAL		C1
D	13-10-12	-110	-110		FRONT	VERT	TOTAL		C1
O	11-10-12	-26	-26		FRONT	VERT	TOTAL		C1
P	9-10-12	-26	-26		FRONT	VERT	TOTAL		C1
Q	5-10-12	-26	-26		FRONT	VERT	TOTAL		C1
S	1-10-12	-110	-110		FRONT	VERT	TOTAL		C1
T	3-10-12	-110	-110		FRONT	VERT	TOTAL		C1
U	7-10-12	-110	-110		FRONT	VERT	TOTAL		C1
V	9-10-12	-110	-110		FRONT	VERT	TOTAL		C1
W	15-10-12	-110	-110		FRONT	VERT	TOTAL		C1
X	17-10-12	-110	-110		FRONT	VERT	TOTAL		C1
Y	19-10-12	-110	-110		FRONT	VERT	TOTAL		C1
Z	21-10-12	-110	-110		FRONT	VERT	TOTAL		C1
AA	23-10-12	-110	-110		FRONT	VERT	TOTAL		C1
AB	25-10-12	-110	-110		FRONT	VERT	TOTAL		C1
AC	27-10-12	-110	-110		FRONT	VERT	TOTAL		C1
AD	29-10-12	-110	-110		FRONT	VERT	TOTAL		C1
AE	31-10-12	-110	-110		FRONT	VERT	TOTAL		C1
AF	33-10-12	-113	-113		FRONT	VERT	TOTAL		C1
AG	1-10-12	-26	-26		FRONT	VERT	TOTAL		C1
AH	3-10-12	-26	-26		FRONT	VERT	TOTAL		C1
AI	7-10-12	-26	-26		FRONT	VERT	TOTAL		C1
AJ	13-10-12	-26	-26		FRONT	VERT	TOTAL		C1
AK	15-10-12	-26	-26		FRONT	VERT	TOTAL		C1
AL	17-10-12	-26	-26		FRONT	VERT	TOTAL		C1
AM	19-10-12	-26	-26		FRONT	VERT	TOTAL		C1
AN	21-10-12	-26	-26		FRONT	VERT	TOTAL		C1
AO	23-10-12	-26	-26		FRONT	VERT	TOTAL		C1
AP	25-10-12	-26	-26		FRONT	VERT	TOTAL		C1
AQ	27-10-12	-26	-26		FRONT	VERT	TOTAL		C1
AR	29-10-12	-26	-26		FRONT	VERT	TOTAL		C1
AS	31-10-12	-26	-26		FRONT	VERT	TOTAL		C1
AT	33-10-12	-27	-27		FRONT	VERT	TOTAL		C1

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408150	T1Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:02:49 2020 Page 1
ID:7vF?ag0E03cRUj6X1[S?kzWYK-zfWlZSolhMeffWnWnG566h7Ury008GacTEqvOzNCnb

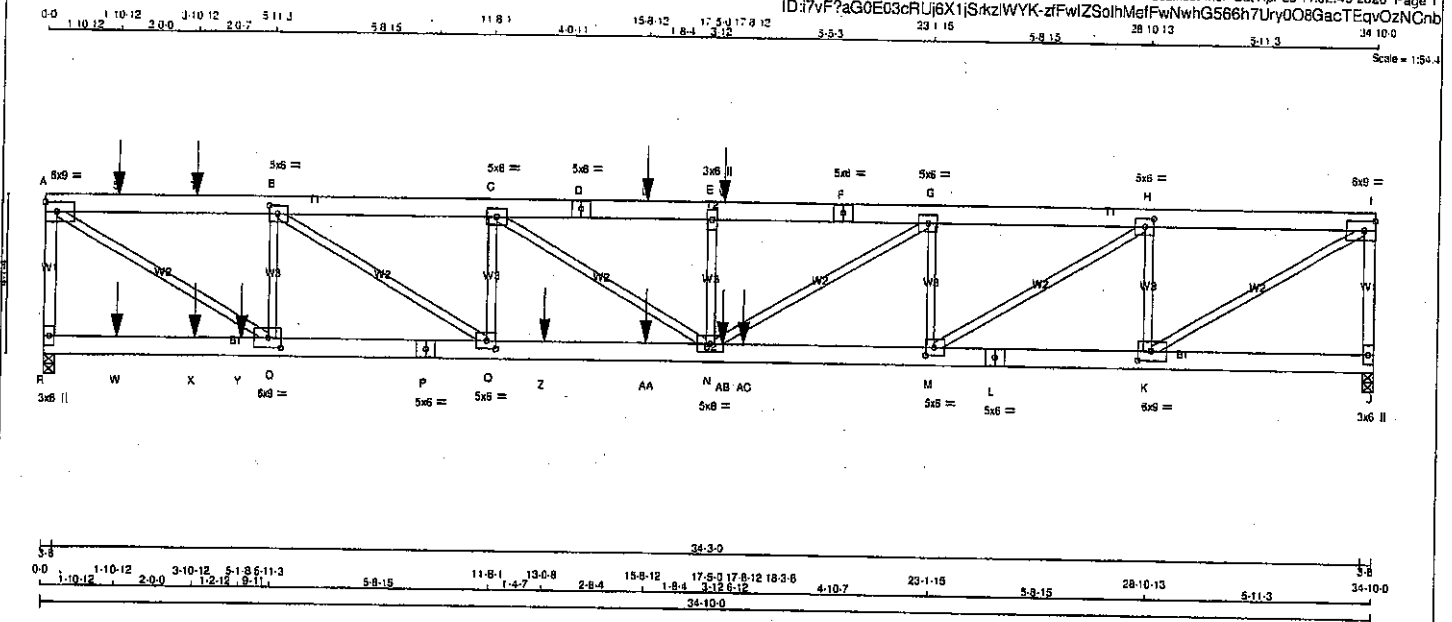

LUMBER	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES				
CHORDS				
R - A	2x4	DRY	No.2	SPF
A - D	2x6	DRY	No.2	SPF
D - F	2x6	DRY	No.2	SPF
F - I	2x6	DRY	No.2	SPF
J - L	2x4	DRY	No.2	SPF
L - P	2x6	DRY	No.2	SPF
P - L	2x6	DRY	No.2	SPF
L - J	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY, SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
R - A	12	TOP
F - J	12	TOP
A - D	12	SIDE(0.0)
D - F	12	SIDE(183.1)
F - I	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
R - P	12	SIDE(0.0)
P - L	12	SIDE(183.1)
L - J	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	UP/LIFT
R	4002	0	4002	0
J	3132	0	3132	0

UNFACTORED REACTIONS

1ST LOASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
R	2824	1886 / 0	0 / 0	0 / 0	0 / 0	938 / 0
J	2212	1470 / 0	0 / 0	0 / 0	0 / 0	742 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.64 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL FITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO					FR-TO		
R-A	-3851 / 0	0.0	0.0 0.44 (1)	6.01	K-I	0 / 5428	0.67 (1)
A-S	-5722 / 0	-91.8	-91.8 0.25 (1)	4.72	A-Q	0 / 6717	0.83 (1)
S-T	-5722 / 0	-91.8	-91.8 0.25 (1)	4.72	K-H	-2763 / 0	0.33 (1)
T-B	-5722 / 0	-91.8	-91.8 0.25 (1)	4.72	Q-B	-2710 / 0	0.32 (1)
B-C	-8846 / 0	-91.8	-91.8 0.27 (1)	3.93	M-H	0 / 4038	0.50 (1)
C-D	-10219 / 0	-91.8	-91.8 0.34 (1)	3.84	B-C	0 / 3700	0.46 (1)
D-U	-10219 / 0	-91.8	-91.8 0.34 (1)	3.84	M-G	-1901 / 0	0.23 (1)
U-E	-10219 / 0	-91.8	-91.8 0.34 (1)	3.84	O-C	-1400 / 0	0.17 (1)
E-V	-10219 / 0	-91.8	-91.8 0.31 (1)	3.67	N-G	0 / 2591	0.32 (1)
V-F	-10219 / 0	-91.8	-91.8 0.31 (1)	3.67	C-N	0 / 1626	0.20 (1)
F-G	-10219 / 0	-91.8	-91.8 0.31 (1)	3.67	N-E	-710 / 0	0.08 (1)
G-H	-8031 / 0	-91.8	-91.8 0.23 (1)	4.14			
H-I	-4822 / 0	-91.8	-91.8 0.15 (1)	5.25			
J-I	-3071 / 0	0.0	0.0 0.35 (1)	6.50			

R-W	0 / 0	-18.5	-18.5 0.15 (1)	10.00
W-X	0 / 0	-18.5	-18.5 0.15 (1)	10.00
X-Y	0 / 0	-18.5	-18.5 0.15 (1)	10.00
Y-Q	0 / 0	-18.5	-18.5 0.15 (1)	10.00
Q-P	0 / 5722	-18.5	-18.5 0.44 (1)	10.00
P-O	0 / 5722	-18.5	-18.5 0.44 (1)	10.00
O-Z	0 / 8846	-18.5	-18.5 0.81 (1)	10.00
Z-AA	0 / 8846	-18.5	-18.5 0.81 (1)	10.00
AA-N	0 / 8846	-18.5	-18.5 0.81 (1)	10.00
N-AB	0 / 8031	-18.5	-18.5 0.74 (1)	10.00
AB-AC	0 / 8031	-18.5	-18.5 0.74 (1)	10.00
AC-M	0 / 8031	-18.5	-18.5 0.74 (1)	10.00
M-L	0 / 4822	-18.5	-18.5 0.33 (1)	10.00
L-K	0 / 4822	-18.5	-18.5 0.33 (1)	10.00
K-J	0 / 0	-18.5	-18.5 0.04 (4)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
S	1-10-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
T	3-10-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	15-8-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	17-8-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	1-10-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
X	3-10-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
Y	5-1-8	-727	-727	---	BACK	VERT	TOTAL	---	C1
Z	13-0-6	-727	-727	---	BACK	VERT	TOTAL	---	C1
AA	15-8-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AB	17-8-12	-26	-26	---	BACK	VERT	TOTAL	---	C1

TOTAL WEIGHT = 2 X 176 = 353 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.5 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/380$ (1.16")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.28")
ALLOWABLE DEFL.(TL) = $L/380$ (1.16")
CALCULATED VERT. DEFL.(TL) = $L/828$ (0.50")

CSI: TC=0.44/1.00 (A-R:1), BC=0.81/1.00 (N-O:1),
WB=0.83/1.00 (A-Q:1), SSI=0.41/1.00 (M-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1587 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (M) (INPUT = 0.90)
JSI METAL= 0.50 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007064 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408150	T1Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Sat Apr 25 11:02:49 2020 Page 2
ID:7vF?aG0E03cRui6X1SkzWYK-SrpVvTQ3 UVGPVZTPnKeJDIEF7bW/gZ NRrzNCra

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	6.0	9.0		Edge
B	TMWW-t	MT20	5.0	6.0	2.50	2.75
C	TMWW-t	MT20	5.0	6.0		
D	TS-t	MT20	5.0	6.0		
E	TMW-w	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMWW-t	MT20	5.0	6.0		
H	TMWW-t	MT20	5.0	6.0	2.50	2.75
I	TMVW-t	MT20	6.0	9.0		Edge
J	BMV1+p	MT20	3.0	6.0		
K	BMWW-t	MT20	6.0	9.0	3.00	4.25
L	BS-t	MT20	5.0	6.0		
M	BMWW-t	MT20	5.0	6.0	2.50	2.75
N	BMWWW-t	MT20	5.0	6.0		
O	BMWW-t	MT20	5.0	6.0	2.50	2.75
P	BS-t	MT20	5.0	6.0		
Q	BMWW-t	MT20	6.0	9.0	3.00	4.25
R	BMV1+p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
AC	18-3-8	-1293	-1293	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

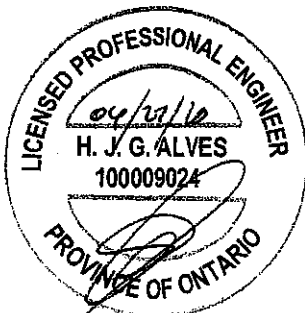


Structural component only
DWG# T-2007064 72

JOB NAME: 408150 TRUSS NAME: T2 QUANTITY: 2 PLY: 1 JOB DESC: GREEN PARK HOMES TRUSS DESC: Tamarack Roof Truss, Burlington

Version 3.310 S Oct 29 2019 MTEK Industries, Inc. Set Apr 25 11:02:50 2020 Page 1

ID:7vF?aG0E03cRUj6X1SrkzWYK-w1MqFT2qidMuZ4116IZBXmNxeiPs5W3npxzHzNcnZ

Scale = 1:54.4

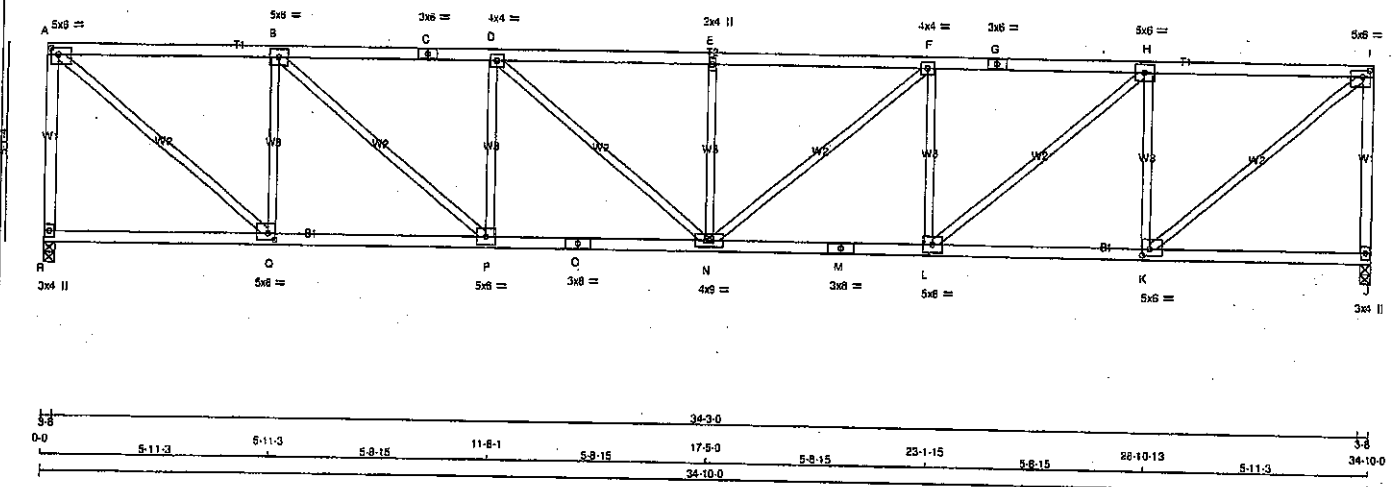

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
R - A	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
C - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
J - I	2x4	DRY	No.2	SPF
R - O	2x4	DRY	No.2	SPF
O - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
 DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWW-t	MT20	5.0	8.0	2.00	2.25
B	TMWW-t	MT20	5.0	8.0		
C	TS-t	MT20	3.0	5.0		
D	TMWW-t	MT20	4.0	4.0		
E	TMWW-t	MT20	2.0	4.0		
F	TMWW-t	MT20	4.0	4.0		
G	TS-t	MT20	3.0	5.0		
H	TMWW-t	MT20	5.0	6.0		
I	TMWW-t	MT20	5.0	8.0	2.00	2.25
J	BMV1-p	MT20	3.0	4.0		
K	BMWW-t	MT20	5.0	6.0	2.00	2.25
L	BMWW-t	MT20	5.0	6.0		
M	BS-t	MT20	3.0	8.0		
N	BMWW-t	MT20	4.0	9.0		
O	BS-t	MT20	3.0	8.0		
P	BMWW-t	MT20	5.0	8.0		
Q	BMWW-t	MT20	5.0	6.0	2.00	2.25
R	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
R	1920	0	0	0
J	1920	0	0	0

UNFACTORED REACTIONS

JT	1ST LOUSE	MAX/MIN. COMPONENT REACTIONS	PERMALIVE	WIND	DEAD	SOIL
R	1358	891 / 0	0 / 0	0 / 0	467 / 0	0 / 0
J	1358	891 / 0	0 / 0	0 / 0	467 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.23 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)	MAX. FACTORED VERT. LOAD (LC4)	MAX. FACTORED VERT. LOAD (LC5)	MAX. FACTORED VERT. LOAD (LC6)	MAX. FACTORED VERT. LOAD (LC7)	MAX. FACTORED VERT. LOAD (LC8)	MAX. FACTORED VERT. LOAD (LC9)	MAX. FACTORED VERT. LOAD (LC10)
R-A	-1875 / 0	0.0	0.0	0.83 (1)	8.13	K-I	0 / 2630	0.59 (1)				
A-B	-2042 / 0	-91.8	-91.8	0.59 (1)	4.10	A-Q	0 / 2630	0.59 (1)				
B-C	-3149 / 0	-91.8	-91.8	0.74 (1)	3.28	K-H	-1535 / 0	0.59 (1)				
C-D	-3149 / 0	-91.8	-91.8	0.74 (1)	3.28	Q-B	-1535 / 0	0.59 (1)				
D-E	-3533 / 0	-91.8	-91.8	0.68 (1)	3.23	L-H	0 / 1444	0.33 (1)				
E-F	-3533 / 0	-91.8	-91.8	0.68 (1)	3.23	B-P	0 / 1444	0.33 (1)				
F-G	-3149 / 0	-91.8	-91.8	0.74 (1)	3.28	L-F	-826 / 0	0.32 (1)				
G-H	-3149 / 0	-91.8	-91.8	0.74 (1)	3.28	P-D	-826 / 0	0.32 (1)				
H-I	-2042 / 0	-91.8	-91.8	0.59 (1)	4.10	N-F	0 / 502	0.11 (1)				
I-J	-1875 / 0	0.0	0.0	0.83 (1)	8.13	D-N	0 / 502	0.11 (1)				
R-Q	0 / 0	-18.5	-18.5	0.15 (4)	10.00	N-E	-537 / 0	0.21 (1)				
Q-P	0 / 2042	-18.5	-18.5	0.40 (1)	10.00							
P-O	0 / 3149	-18.5	-18.5	0.59 (1)	10.00							
O-N	0 / 3149	-18.5	-18.5	0.59 (1)	10.00							
N-M	0 / 3149	-18.5	-18.5	0.59 (1)	10.00							
M-L	0 / 3149	-18.5	-18.5	0.59 (1)	10.00							
L-K	0 / 2042	-18.5	-18.5	0.40 (1)	10.00							
K-J	0 / 0	-18.5	-18.5	0.15 (4)	10.00							

TOTAL WEIGHT = 2 X 143 = 286 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (1.16")
 CALCULATED VERT. DEFL. (LL) = $L/999$ (0.23")
 ALLOWABLE DEFL. (TL) = $L/360$ (1.16")
 CALCULATED VERT. DEFL. (TL) = $L/998$ (0.42")

CSI: $TQ=0.83/1.00$ (A-R-1), $BC=0.56/1.00$ (N-P-1),
 $WB=0.59/1.00$ (I-K-1), $SSI=0.25/1.00$ (A-B-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	788	1987	1856


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (A) (INPUT = 0.90)
 JSI METAL = 0.99 (M) (INPUT = 1.00)

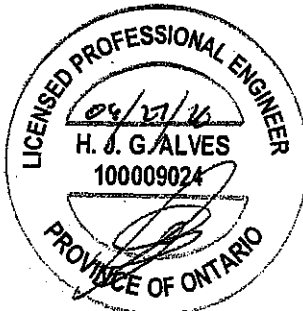

Structural component only
 DWG# T-2007065

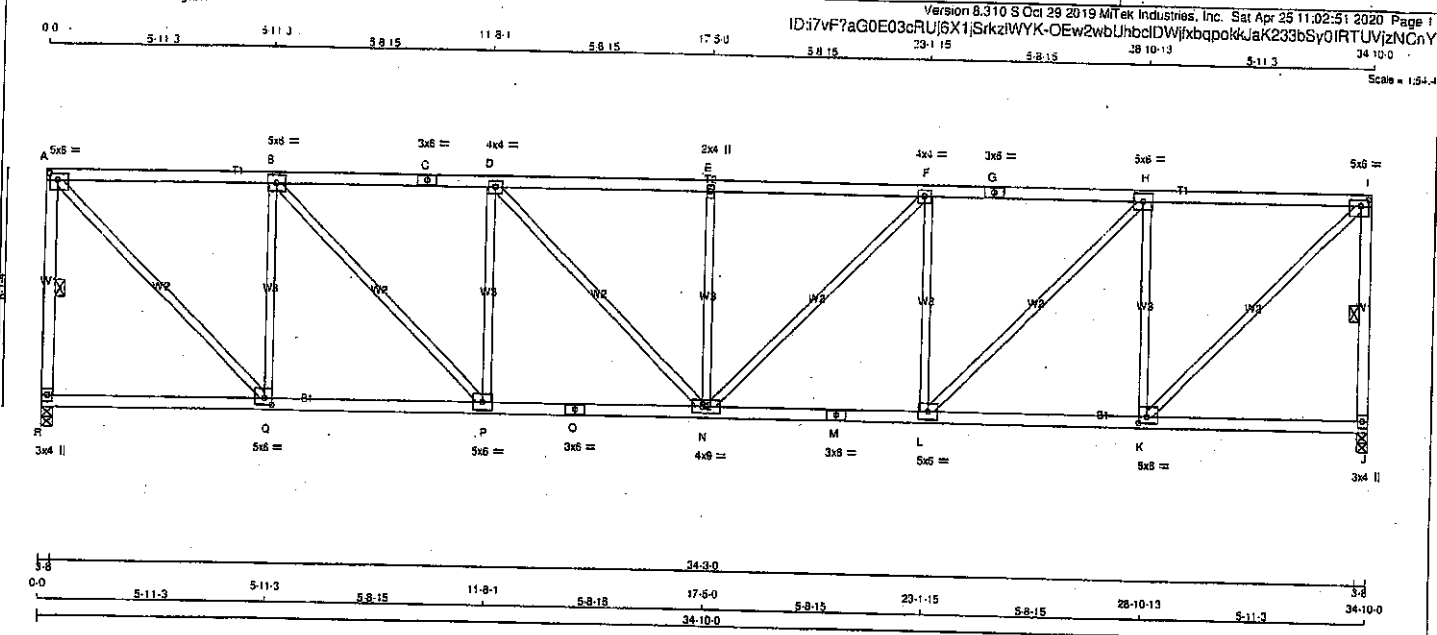

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
R - A	2x4	DRY No.2
A - C	2x4	DRY No.2
C - G	2x4	DRY No.2
G - I	2x4	DRY No.2
J - L	2x4	DRY No.2
R - O	2x4	DRY No.2
O - M	2x4	DRY No.2
M - J	2x4	DRY No.2

ALL WEBS 2x3 DRY No.2
 DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-I	MT20	5.0	6.0	2.00	2.50
B	TMVW-I	MT20	5.0	6.0		
C	TS-I	MT20	3.0	6.0		
D	TMVW-I	MT20	4.0	4.0		
E	TMW+V	MT20	2.0	4.0		
F	TMVW-I	MT20	4.0	4.0		
G	TS-I	MT20	3.0	6.0		
H	TMVW-I	MT20	5.0	6.0		
I	TMVW-I	MT20	5.0	6.0	2.00	2.50
J	BMV1+P	MT20	3.0	4.0		
K	BMVW-I	MT20	5.0	6.0	2.00	2.50
L	BMVW-I	MT20	5.0	6.0		
M	BS-I	MT20	3.0	6.0		
N	BMVWVW-I	MT20	4.0	9.0		
O	BS-I	MT20	3.0	6.0		
P	BMVWVW-I	MT20	5.0	6.0		
Q	BMVW-I	MT20	5.0	6.0	2.00	2.50
R	BMV1+P	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECORD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
R	1920	0	1920	0	3-8	3-8
J	1920	0	1920	0	3-8	3-8

UNFACTORED REACTIONS							
	1ST CASE		MAX/MIN. COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1358	891 / 0	0 / 0	0 / 0	0 / 0	467 / 0	0 / 0
J	1358	891 / 0	0 / 0	0 / 0	0 / 0	467 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.59 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-R, I-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC)
FR-TO		FROM	TO	LENGTH	FR-TO		
R-A	-1875 / 0	0.0	0.0	0.33 (1)	4.90	K-I	0 / 2368
A-B	-1891 / 0	-91.8	-91.8	0.55 (1)	4.46	A-Q	0 / 2368
B-C	-2608 / 0	-91.8	-91.8	0.66 (1)	3.63	K-H	-1536 / 0
C-D	-2608 / 0	-91.8	-91.8	0.66 (1)	3.63	Q-B	-1536 / 0
D-E	-2927 / 0	-91.8	-91.8	0.58 (1)	3.59	L-H	0 / 1304
E-F	-2927 / 0	-91.8	-91.8	0.58 (1)	3.59	P-P	0 / 1304
F-G	-2608 / 0	-91.8	-91.8	0.66 (1)	3.63	L-F	-826 / 0
G-H	-2608 / 0	-91.8	-91.8	0.66 (1)	3.63	P-D	-826 / 0
H-I	-1891 / 0	-91.8	-91.8	0.55 (1)	4.46	N-F	0 / 453
I-J	-1875 / 0	0.0	0.0	0.33 (1)	4.90	D-N	0 / 453
						N-E	-537 / 0

TOTAL WEIGHT = 2 X 153 = 305 lb

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.16")
 CALCULATED VERT. DEFL. (LL) = L/998 (0.18")
 ALLOWABLE DEFL. (TL) = L/360 (1.16")
 CALCULATED VERT. DEFL. (TL) = L/998 (0.33")

CSI: TO=0.66/1.00 (F-H:1), BC=0.47/1.00 (N-P:1), WB=0.30/1.00 (H-K:1), SS=0.25/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.88 (I) (INPUT = 0.90)
 JSI METAL= 0.83 (M) (INPUT = 1.00)

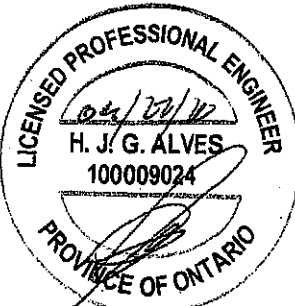

JOB NAME: 408150 TRUSS NAME: T4 QUANTITY: 2 PLY: 1 JOB DESC: GREEN PARK HOMES TRUSS DESC: Tamarack Roof Truss, Burlington DRWG NO. 34-10-0

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:02:52 2020 Page 1
ID: J7vF7aG0E03cRUj8X1ISkzIWYK-sQUQ8wVJMV47IE88XL1GyrhNSOJK7q9W4C12AzNcnX

Scale: 1/8" = 1'-0"

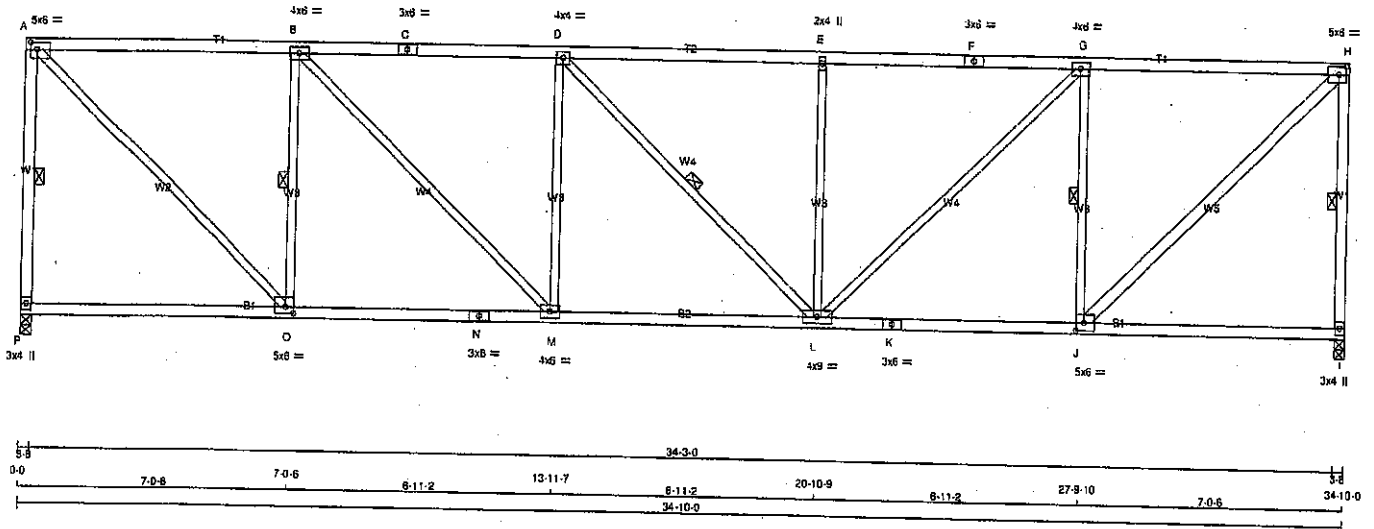

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
P - A	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
C - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - I	2x4	DRY	No.2	SPF	
I - N	2x4	DRY	No.2	SPF	
N - K	2x4	DRY	No.2	SPF	
K - J	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2
EXCEPT
J - H 2x4 DRY No.2
DRY, SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-I	MT20	5.0	6.0	2.25
B	TMVW-I	MT20	4.0	6.0	
C	TS-I	MT20	3.0	6.0	
D	TMVW-I	MT20	4.0	4.0	
E	TMVW-I	MT20	2.0	4.0	
F	TS-I	MT20	3.0	6.0	
G	TMVW-I	MT20	4.0	6.0	
H	TMVW-I	MT20	5.0	6.0	2.50
I	BMV1-p	MT20	3.0	4.0	
J	BMVW-I	MT20	5.0	6.0	2.50
K	BS-I	MT20	3.0	6.0	
L	BMVW-I	MT20	4.0	9.0	
M	BMVW-I	MT20	4.0	6.0	
N	BS-I	MT20	3.0	6.0	
O	BMVW-I	MT20	5.0	6.0	2.00
P	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
P	1920	0	1920	0	3-8	3-8
I	1920	0	1920	0	3-8	3-8

UNFACTORED REACTIONS

JT	1ST LOSE COMBINED		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM. LIVE	DOWN			
P	1358	891 / 0	0 / 0	0 / 0	0 / 0	467 / 0	0 / 0
I	1358	891 / 0	0 / 0	0 / 0	0 / 0	467 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.31 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-P, H-I, B-O, D-L, G-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLP)	MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
P-A	-1868 / 0	0.0	0.0 0.43 (1)	4.91	A-O	0 / 2315	0.52 (1)
A-B	-1662 / 0	-91.8	-91.8 0.82 (1)	4.04	O-B	-1468 / 0	0.47 (1)
B-C	-2416 / 0	-91.8	-91.8 0.95 (1)	3.33	B-M	0 / 1058	0.24 (1)
C-D	-2416 / 0	-91.8	-91.8 0.95 (1)	3.33	M-D	-817 / 0	0.54 (1)
D-E	-2415 / 0	-91.8	-91.8 0.74 (1)	3.73	D-L	-2 / 0	0.00 (1)
E-F	-2415 / 0	-91.8	-91.8 0.96 (1)	3.31	L-E	-618 / 0	0.54 (1)
F-G	-2415 / 0	-91.8	-91.8 0.98 (1)	3.31	L-G	0 / 1054	0.24 (1)
G-H	-1863 / 0	-91.8	-91.8 0.82 (1)	4.02	J-G	-1465 / 0	0.47 (1)
H-I	-1868 / 0	0.0	0.0 0.43 (1)	4.91	J-H	0 / 2316	0.37 (1)
P-O	0 / 0	-18.5	-18.5 0.22 (4)	10.00			
O-N	0 / 1882	-18.5	-18.5 0.39 (1)	10.00			
N-M	0 / 1882	-18.5	-18.5 0.39 (1)	10.00			
M-L	0 / 2416	-18.5	-18.5 0.47 (1)	10.00			
L-K	0 / 1863	-18.5	-18.5 0.39 (1)	10.00			
K-J	0 / 1883	-18.5	-18.5 0.39 (1)	10.00			
J-I	0 / 0	-18.5	-18.5 0.22 (4)	10.00			

TOTAL WEIGHT = 2 X 157 = 313 LBS

DESIGN CRITERIA

SPECIFIED LOADS:

SPECIFIED LOADS:			
TOP CH.	LL	= 25.6	PS
	DL	= 6.0	PS
BOT CH.	LL	= 0.0	PS
	DL	= 7.4	PS
TOTAL LOAD		= 39.0	PS

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.16")
CALCULATED VERT. DEFL. (LL) = L/899 (0.15")
ALLOWABLE DEFL. (TL) = L/360 (1.16")
CALCULATED VERT. DEFL. (TL) = L/999 (0.23")

CSI: TC=0.99/1.00 (E-G:1), BC=0.47/1.00 (L-M:1), WB=0.54/1.00 (D-M:1), SS=0.30/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00,

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788 1997 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (A) (INPUT = 0.90)
JSI METAL= 0.53 (K) (INPUT = 1.00)




Structural component only
DWG# T-2007067

JOB NAME 408150	TRUSS NAME T5	QUANTITY 10	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	------------------	----------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 11:02:53 2020 Page 1
ID:7vF?ag0E03cRUj6X1jSkziWYK-Kc2pLGWx7D?xlpKfGp9O6s6l3ONJlkybaczNCnW
34-9-8 34-10-0
3-9
Scale = 1:54.5

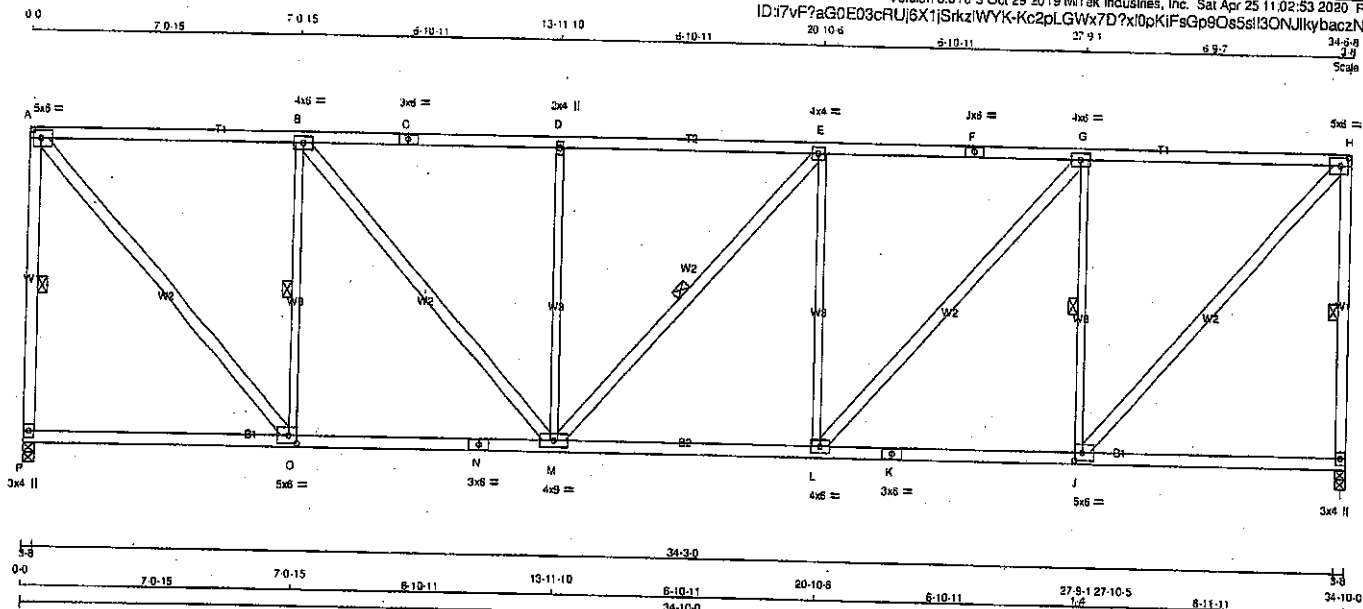

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
P - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
I - H	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
ALL WEBS EXCEPT			
J - G	2x3	DRY	No.2
O - B	2x3	DRY	No.2
L - E	2x3	DRY	No.2
M - D	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	5.0	6.0	2.50	2.50
B	TMVW-t	MT20	4.0	6.0		
C	TS-t	MT20	3.0	6.0		
D	TMVW-t	MT20	2.0	4.0		
E	TMVW-t	MT20	4.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMVW-t	MT20	4.0	6.0		
H	TMVW-t	MT20	5.0	6.0	2.50	2.50
I	BMVW-t	MT20	3.0	4.0		
J	BMVW-t	MT20	5.0	6.0	2.50	2.50
K	BS-t	MT20	3.0	6.0		
L	BMVW-t	MT20	4.0	6.0		
M	BMVW-t	MT20	4.0	6.0		
N	BS-t	MT20	3.0	6.0		
O	BMVW-t	MT20	5.0	6.0	2.50	2.50
P	BMVW-t	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	SPF	GROSS REACTION	VERT	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
P	SPF	1920	0	1920	0	0	3-8	3-8	3-8
I	SPF	1920	0	1920	0	0	3-8	3-8	3-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
P	COMBINED	1358	891 / 0	0 / 0	0 / 0	0 / 0	467 / 0	0 / 0
I	COMBINED	1358	891 / 0	0 / 0	0 / 0	0 / 0	467 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-P, H-I, G-J, B-O, E-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1	MAX. UNBRACED LENGTH	MEMB.	FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM	TO		FR-TO		
P-A	-1868 / 0	0.0	0.0	0.55 (1)	J-H	0 / 2171	0.35 (1)
A-B	-1458 / 0	-91.8	-91.8	0.80 (1)	A-O	0 / 2171	0.35 (1)
B-C	-2108 / 0	-91.8	-91.8	0.90 (1)	J-G	-1463 / 0	0.61 (1)
C-D	-2108 / 0	-91.8	-91.8	0.90 (1)	O-B	-1462 / 0	0.61 (1)
D-E	-2108 / 0	-91.8	-91.8	0.88 (1)	L-G	0 / 982	0.18 (1)
E-F	-2108 / 0	-91.8	-91.8	0.90 (1)	B-M	0 / 980	0.18 (1)
F-G	-2108 / 0	-91.8	-91.8	0.90 (1)	L-E	-613 / 0	0.78 (1)
G-H	-1458 / 0	-91.8	-91.8	0.79 (1)	M-D	-612 / 0	0.77 (1)
H-I	-1868 / 0	0.0	0.0	0.55 (1)	M-E	-2 / 0	0.00 (1)
P-O	0 / 0	-18.5	-18.5	0.22 (4)			
O-N	0 / 1458	-18.5	-18.5	0.36 (1)			
N-M	0 / 1458	-18.5	-18.5	0.36 (1)			
M-L	0 / 2108	-18.5	-18.5	0.42 (1)			
L-K	0 / 1458	-18.5	-18.5	0.36 (1)			
K-J	0 / 1458	-18.5	-18.5	0.36 (1)			
J-I	0 / 0	-18.5	-18.5	0.22 (4)			

TOTAL WEIGHT = 10 X 178 = 1785 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/899 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/899 (0.24")

CS1: TC=0.90/1.00 (B-D:1), BC=0.42/1.00 (L-M:1), WB=0.78/1.00 (E-L:1), SS1=0.31/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1668


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (A) (INPUT = 0.90)
JSI METAL= 0.47 (N) (INPUT = 1.00)

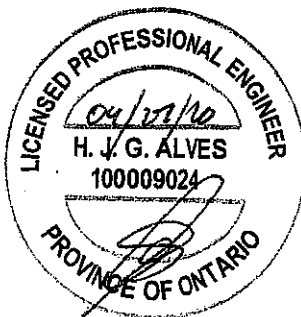

Structural component only
DWG# T-2007068

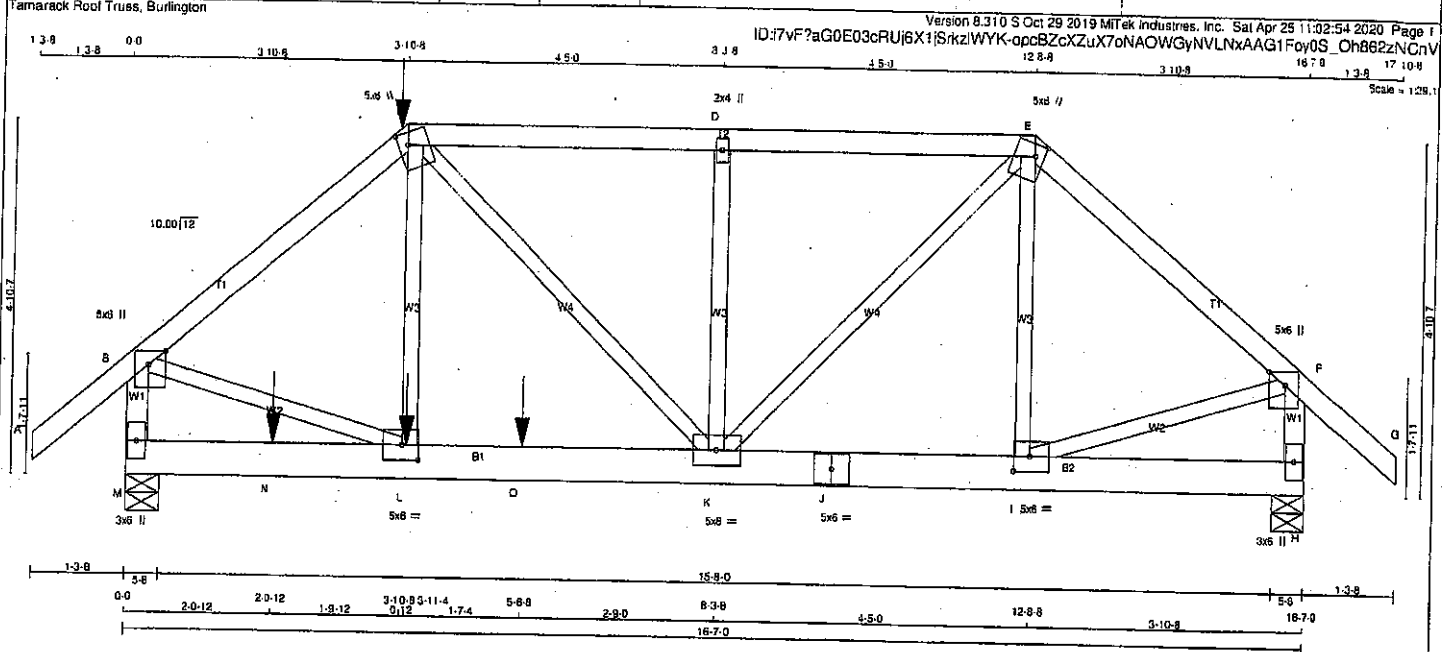

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - K	2x4	DRY	No.2
K - M	2x4	DRY	No.2
M - O	2x4	DRY	No.2
O - Q	2x4	DRY	No.2
Q - S	2x4	DRY	No.2
S - U	2x4	DRY	No.2
U - W	2x4	DRY	No.2
W - Y	2x4	DRY	No.2
Y - A	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	8.0	Edge 2.75
C	TTWW+m	MT20	5.0	6.0	2.00 1.50
D	TMVW-w	MT20	2.0	4.0	
E	TTWW+m	MT20	5.0	8.0	2.00 1.50
F	TMVW+p	MT20	5.0	8.0	Edge 2.75
H	BMV1+p	MT20	3.0	6.0	
I	BMVW-t	MT20	5.0	6.0	2.50 2.75
J	BS-t	MT20	5.0	8.0	
K	BMVW-w	MT20	5.0	8.0	
L	BMVW-t	MT20	5.0	6.0	2.50 2.75
M	BMV1+p	MT20	3.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	UPLIFT		
M	1888	0	1888	0	5-8	5-8
H	1422	0	1422	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
M	1329	909 / 0	0 / 0	0 / 0	0 / 0	420 / 0	0 / 0
H	1001	683 / 0	0 / 0	0 / 0	0 / 0	318 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.55 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 41	-91.8	-91.8 0.14 (1)	10.00	L-C	0 / 383	0.09 (1)
B-C	-1847 / 0	-91.8	-91.8 0.34 (1)	4.55	C-K	0 / 310	0.08 (1)
C-D	-1641 / 0	-91.8	-91.8 0.36 (1)	4.72	K-D	-481 / 0	0.16 (1)
D-E	-1641 / 0	-91.8	-91.8 0.36 (1)	4.72	K-E	0 / 1010	0.25 (1)
E-F	-1225 / 0	-91.8	-91.8 0.36 (1)	5.40	E-J	-274 / 0	0.09 (1)
F-G	0 / 41	-91.8	-91.8 0.14 (1)	10.00	B-L	0 / 1480	0.37 (1)
M-B	-1926 / 0	0.0	0.0 0.22 (1)	6.01	L-F	0 / 981	0.24 (1)
H-F	-1380 / 0	0.0	0.0 0.16 (1)	6.88			
M-N	0 / 0	-18.5	-18.5 0.24 (1)	10.00			
N-L	0 / 0	-18.5	-18.5 0.24 (1)	10.00			
L-O	0 / 1424	-18.5	-18.5 0.70 (1)	10.00			
O-K	0 / 1424	-18.5	-18.5 0.70 (1)	10.00			
K-J	0 / 932	-18.5	-18.5 0.29 (1)	10.00			
J-I	0 / 932	-18.5	-18.5 0.29 (1)	10.00			
I-H	0 / 0	-18.5	-18.5 0.04 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	3-10-8	-241	-241	---	FRONT	VERT	TOTAL	---	C1
L	3-11-4	-17	-17	---	FRONT	VERT	TOTAL	---	C1
N	2-0-12	-17	-17	---	FRONT	VERT	TOTAL	---	C1
O	5-6-8	-953	-953	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 085-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (0.55")
CALCULATED VERT. DEFL.(TL) = L/999 (0.10")

CSI: TC=0.36/1.00 (C-D:1), BC=0.70/1.00 (K-L:1), WB=0.37/1.00 (B-L:1), SS=0.45/1.00 (K-L:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1657 788 1987 1655

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (C) (INPUT = 0.90)
JSI METAL= 0.57 (J) (INPUT = 1.00)





CHORDS			WEBS					
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO			
A-B	-718 / 0	-91.8	-91.8	0.39 (1)	6.25	H-B		
B-C	-558 / 0	-91.8	-91.8	0.28 (1)	6.25	B-F	-34 / 68	0.02 (4)
C-D	-729 / 0	-91.8	-91.8	0.42 (1)	6.25	F-H	0 / 14	0.00 (1)
I-A	-860 / 0	0.0	0.0	0.09 (1)	7.81	A-C	-23 / 74	0.03 (4)
E-D	-858 / 0	0.0	0.0	0.09 (1)	7.81	F-D	0 / 587	0.13 (1)
							0 / 572	0.13 (1)
I-H	0 / 0	-18.5	-18.5	0.13 (4)	10.00			
H-G	0 / 550	-18.5	-18.5	0.18 (4)	10.00			
G-F	0 / 550	-18.5	-18.5	0.18 (4)	10.00			
F-E	0 / 0	-18.5	-18.5	0.14 (4)	10.00			




JOB NAME	TRUSS NAME	QUANTITY	PLY.	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408150	T8	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 11:02:56 2020 Page 1

ID:7vF?ag0E03cRUj6X1jSrKzIWK-IBkxZlYpQ8NWcLXvNPNPzRo0YI3nGGpRiAFBxzNCnT

Scale = 1:43.9

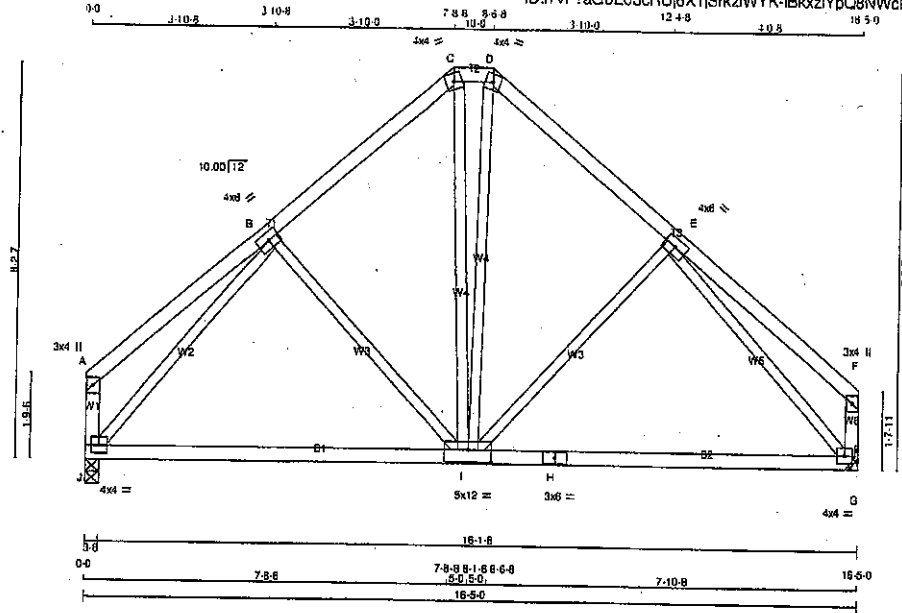

TOTAL WEIGHT = 77 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
J - A	2x4	DRY	No.2
G - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2
H - G	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A - TMV+p	MT20	3.0	4.0		
B - TMWW-t	MT20	4.0	6.0		
C - TTW-m	MT20	4.0	4.0		
D - TTW-m	MT20	4.0	4.0		
E - TMV+p	MT20	3.0	4.0		
F - BMVW-t	MT20	4.0	4.0		
G - BMVW-t	MT20	3.0	6.0		
H - BS-t	MT20	5.0	12.0	3.00	6.00
I - BMVW-t	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

SPF	FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
SPF	VERT	HORZ	DOWN	UPLIFT
J	905	0	905	0
G	905	0	905	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	640	420 / 0	0 / 0	0 / 0	0 / 0	0 / 0	220 / 0	0 / 0
G	640	420 / 0	0 / 0	0 / 0	0 / 0	0 / 0	220 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED	VERT. LOAD	LC1	MAX	MAX	UNBRAC	MEMB.	WEBS	MAX. FACTORED	FORCE	MAX
FR-TO												
A-B	0 / 27	-91.8	-91.8	0.22 (1)	10.00	8-1	-163 / 0	0.11 (1)				
B-C	-649 / 0	-91.8	-91.8	0.17 (1)	6.25	I-E	-190 / 0	0.13 (1)				
C-D	-489 / 0	-91.8	-91.8	0.01 (1)	6.25	J-B	-930 / 0	0.54 (1)				
D-E	-850 / 0	-91.8	-91.8	0.18 (1)	6.25	E-G	-935 / 0	0.57 (1)				
E-F	0 / 27	-91.8	-91.8	0.28 (1)	10.00	C-I	0 / 221	0.05 (1)				
J-A	-129 / 0	0.0	0.0	0.01 (1)	7.81	I-D	0 / 222	0.05 (1)				
G-F	-137 / 0	0.0	0.0	0.01 (1)	7.81							
J-I	0 / 590	-18.5	-18.5	0.41 (4)	10.00							
I-H	0 / 608	-18.5	-18.5	0.41 (4)	10.00							
H-G	0 / 608	-18.5	-18.5	0.41 (4)	10.00							

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
BOT CH.	LL = 6.0 PSF
	LL = 0.0 PSF
	LL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.55")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TC=0.23/1.00 (E-F:1), BC=0.41/1.00 (G-I:4), WB=0.57/1.00 (E-G:1), SS=0.13/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MT20	618	354	1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.75 (G) (INPUT = 0.90)
JSI METAL = 0.23 (G) (INPUT = 1.00)



Structural component only
DWG# T-2007071

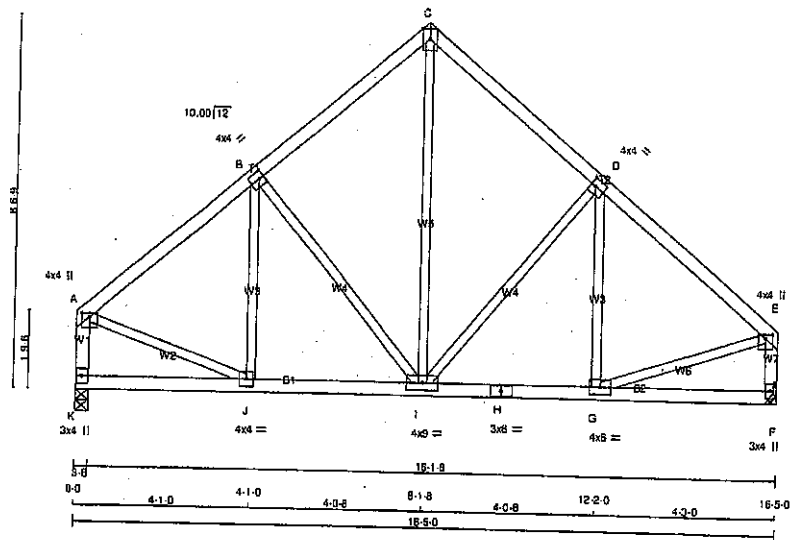

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
K - A	2x4	DRY	No.2
F - E	2x4	DRY	No.2
K - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
B	TMVW-t	MT20	4.0	4.0	2.00	1.25
C	TTW+p	MT20	4.0	8.0	Edge	
D	TMVW-t	MT20	4.0	4.0	2.00	1.25
E	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVW-t	MT20	4.0	8.0		
H	BS-t	MT20	3.0	6.0		
I	BMVW-t	MT20	4.0	9.0		
J	BMVW-t	MT20	4.0	4.0		
K	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	UP-LIFT	IN-SX
K 905	0	0	3-8
F 905	0	0	3-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	840	420 / 0	0 / 0	0 / 0	0 / 0	220 / 0	0 / 0	0 / 0
F	840	420 / 0	0 / 0	0 / 0	0 / 0	220 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO				FR-TO			
A-B	-772 / 0	-91.8	-91.8 0.20 (1)	J-B	-135 / 21	6.25	
B-C	-620 / 0	-91.8	-91.8 0.19 (1)	B-I	-251 / 0	6.25	0.05 (1)
C-D	-822 / 0	-91.8	-91.8 0.20 (1)	I-C	0 / 478	6.25	0.18 (1)
D-E	-795 / 0	-91.8	-91.8 0.21 (1)	I-D	-278 / 0	6.25	0.11 (1)
K-A	-873 / 0	0.0	0.0 0.10 (1)	G-D	-110 / 31	7.81	0.20 (1)
F-E	-872 / 0	0.0	0.0 0.09 (1)	A-J	0 / 653	7.81	0.04 (1)
				G-E	0 / 662	7.81	0.15 (1)
K-J	0 / 0	-18.5	-18.5 0.07 (4)				
J-I	0 / 615	-18.5	-18.5 0.13 (1)				
I-H	0 / 633	-18.5	-18.5 0.14 (1)				
H-G	0 / 633	-18.5	-18.5 0.14 (1)				
G-F	0 / 0	-18.5	-18.5 0.07 (4)				

TOTAL WEIGHT = 77 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
BOT CH. LL	= 6.0 PSF
DL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/380$ (0.55")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.02")
ALLOWABLE DEFL. (TL) = $L/380$ (0.55")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.03")

CSI: TC=0.21/1.00 (D-E:1), SC=0.14/1.00 (G-I:1), WB=0.20/1.00 (D-I:1), SS=0.14/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PS)	SECTION (PL)
MT20	518	354	1687
	768	1987	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (E) (INPUT = 0.90)
JSI METAL= 0.24 (E) (INPUT = 1.00)

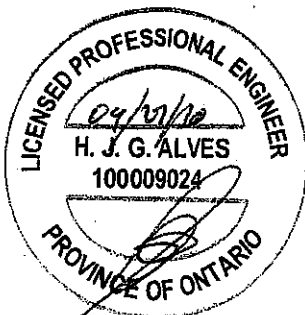

Structural component only
DWG# T-2007072

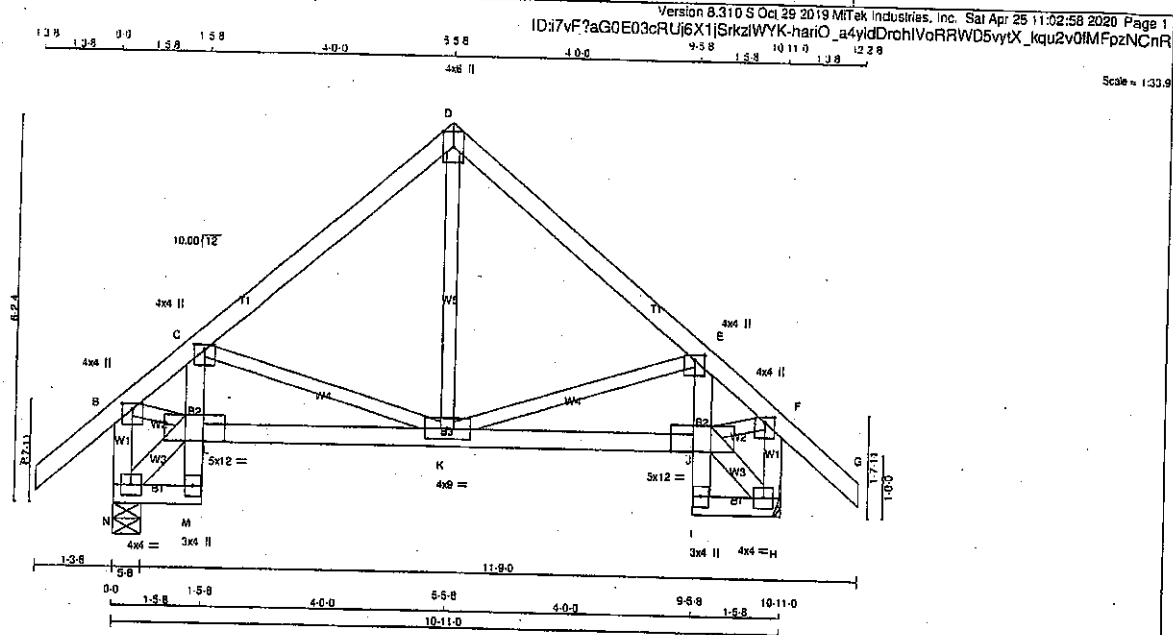

LUMBER

CHORDS	SIZE	DRY	No.2
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
N - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
N - M	2x4	DRY	No.2
M - C	2x4	DRY	No.2
L - J	2x4	DRY	No.2
I - E	2x4	DRY	No.2
I - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
N - L	2x4	DRY	No.2
J - H	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B, C, E, F					
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
D	TTW+p	MT20	4.0	6.0	Edge
H	BMVW1-i	MT20	4.0	4.0	
I	BMV+p	MT20	3.0	4.0	
J	BVMWW-i	MT20	5.0	12.0	5.00 7.75
K	BMVWW-i	MT20	4.0	9.0	
L	BVMWW-i	MT20	5.0	12.0	5.00 7.75
M	BMV+p	MT20	3.0	4.0	
N	BMVW1-i	MT20	4.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	IN-SX	IN-SX
N 729	0	729	0
H 729	0	729	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 1-8.

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT COMBINED	SNOW	LIVE PERM.LIVE WIND DEAD SOIL
N 513	350 / 0	0 / 0 0 / 0 0 / 0 163 / 0 0 / 0
H 513	350 / 0	0 / 0 0 / 0 0 / 0 163 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PL)	MAX. FACTORED CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PL)	MAX. FACTORED CS1 (LC)
FR-TO				FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	C-K	-211 / 0	0.07 (1)	
B-C	-647 / 0	-91.8	-91.8 0.14 (1)	K-D	0 / 229	0.05 (1)	
C-D	-447 / 0	-91.8	-91.8 0.19 (1)	K-E	-210 / 0	0.07 (1)	
D-E	-447 / 0	-91.8	-91.8 0.18 (1)	N-L	-26 / 0	0.00 (1)	
E-F	-646 / 0	-91.8	-91.8 0.14 (1)	B-L	0 / 527	0.12 (1)	
F-G	0 / 41	-91.8	-91.8 0.13 (1)	J-F	0 / 526	0.12 (1)	
N-B	-701 / 0	0.0	0.0 0.07 (1)	J-H	-26 / 0	0.00 (1)	
H-F	-701 / 0	0.0	0.0 0.07 (1)				
N-M	0 / 20	-18.5	-18.5 0.01 (4)				
M-L	0 / 14	0.0	0.0 0.03 (1)				
L-C	-92 / 2	0.0	0.0 0.02 (1)				
L-K	0 / 528	-18.5	-18.5 0.13 (1)				
K-J	0 / 527	-18.5	-18.5 0.13 (1)				
I-J	0 / 14	0.0	0.0 0.03 (1)				
J-E	-93 / 2	0.0	0.0 0.02 (1)				
I-H	0 / 20	-18.5	-18.5 0.01 (4)				

TOTAL WEIGHT = 2 X 56 = 112 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 26.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.36")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.36")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CS1: TC=0.19/1.00 (C-D:1), BC=0.13/1.00 (K-L:1), WB=0.12/1.00 (B-L:1), SS=0.13/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.74 (F) (INPUT = 0.90)
JSI METAL = 0.20 (F) (INPUT = 1.00)




Structural component only
DWG# T-2007073

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 2019 MTEK Industries, Inc. Sat Apr 25 11:02:59 2020 Page 1
ID:7vF7aG0E03cRui6X1jSrhzlWYK-9mP4cKaij34TxGU3Vzg2Qa15HssTHx87gPvoGzNCnQ

Scale = 1:25.4

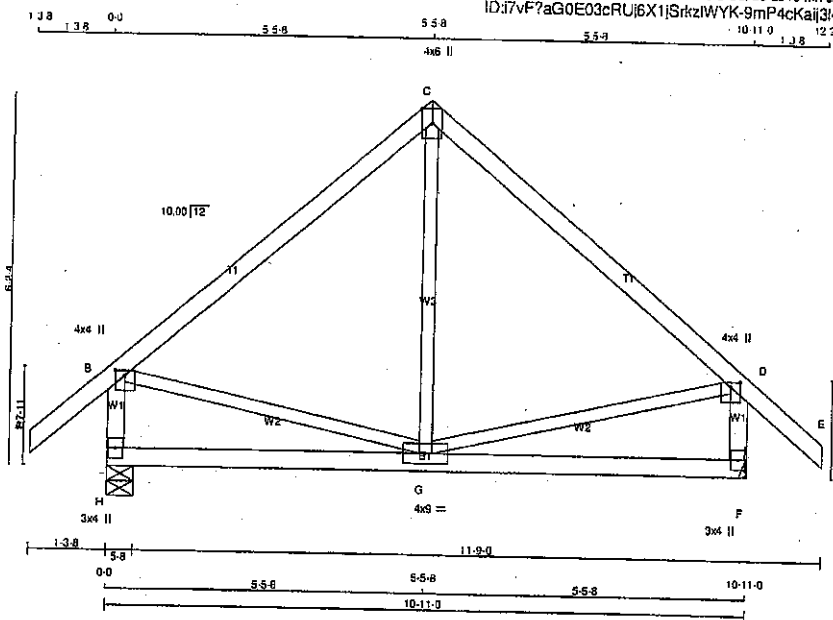

LUMBER

N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - D	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS EXCEPT 2x3 DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW+p	MT20	4.0	8.0	Edge	
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-t	MT20	4.0	9.0		
H	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
H	729	0	729	0
F	729	0	729	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	513	350 / 0	0 / 0	0 / 0	0 / 0	163 / 0	0 / 0
F	513	350 / 0	0 / 0	0 / 0	0 / 0	163 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8 -91.8	0.13 (1)	G-C	-15 / 89	0.03 (4)	
B-C	-380 / 0	-91.8 -91.8	0.35 (1)	B-G	0 / 300	0.07 (1)	
C-D	-380 / 0	-91.8 -91.8	0.35 (1)	G-D	0 / 300	0.07 (1)	
D-E	0 / 41	-91.8 -91.8	0.13 (1)				
H-B	-890 / 0	0.0 0.0	0.07 (1)				
F-D	-890 / 0	0.0 0.0	0.07 (1)				
H-G	0 / 0	-18.5 -18.5	0.16 (4)				
G-F	0 / 0	-18.5 -18.5	0.16 (4)				

TOTAL WEIGHT = 49 lb

(M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL = 8.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015.

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2019, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.36")
CALCULATED VERT. DEFL.(LL) = L/899 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.36")
CALCULATED VERT. DEFL.(TL) = L/899 (0.02")

CSI: TC=0.35/1.00 (B-C:1), BC=0.16/1.00 (G-H:4),
WB=0.07/1.00 (D-G:1), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1687 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.62 (D) (INPUT = 0.90)
JSI METAL= 0.17 (D) (INPUT = 1.00)



Structural component only
DWG# T-2007074

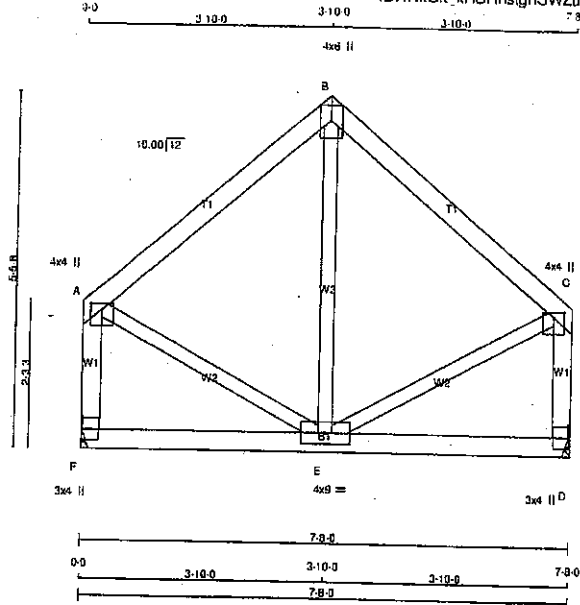

Scale = 1:32.5

LUMBER
N.L.G.A. RULES

CHORDS	SIZE	LUMBER
A - B	2x4	DRY No.2
B - C	2x4	DRY No.2
F - A	2x4	DRY No.2
D - C	2x4	DRY No.2
F - D	2x4	DRY No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
B	TTW+p	MT20	4.0	6.0	Edge	
C	TMVW+p	MT20	4.0	4.0	1.00	2.00
D	BMV1+p	MT20	3.0	4.0		
E	BMVWW-1	MT20	4.0	9.0		
F	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
F	423	0	423	0	0	MECHANICAL
D	423	0	423	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D. MINIMUM BEARING LENGTH AT JOINT F = 1-8, JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST LOASE COMBINED	MAX/MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	289	195 / 0	0 / 0	0 / 0	0 / 0	103 / 0	0 / 0
D	289	195 / 0	0 / 0	0 / 0	0 / 0	103 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO				FR-TO			
A-B	-214 / 0	-91.8	-91.8 0.17 (1)	E-B	-78 / 37	0.03 (1)	
B-C	-214 / 0	-91.8	-91.8 0.17 (1)	A-E	0 / 184	0.04 (1)	
F-A	-395 / 0	0.0	0.0 0.05 (1)	E-C	0 / 184	0.04 (1)	
D-C	-395 / 0	0.0	0.0 0.05 (1)				
F-E	0 / 0	-18.5	-18.5 0.08 (4)				
E-D	0 / 0	-18.5	-18.5 0.08 (4)				

TOTAL WEIGHT = 35 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.28")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.17/1.00 (B-C:1) , BC=0.08/1.00 (D-E:4) , WB=0.04/1.00 (A-E:1) , SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1658


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.31 (C) (INPUT = 0.90)
JSI METAL= 0.09 (C) (INPUT = 1.00)

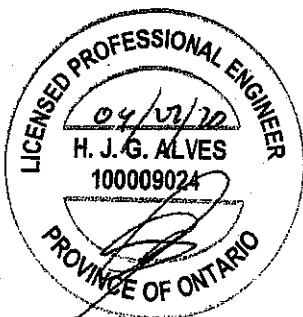

JOB NAME 408150	TRUSS NAME T12S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

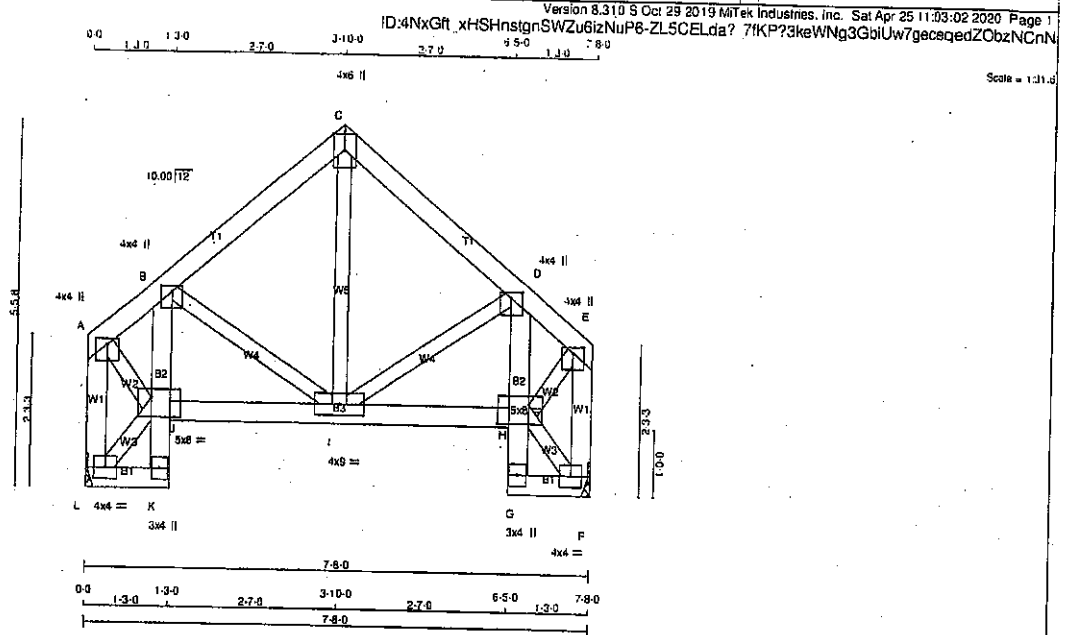

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - K	2x4	DRY	No.2
K - B	2x4	DRY	No.2
B - H	2x4	DRY	No.2
H - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - J	2x4	DRY	No.2

ALL WEBS EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A, B, D, E						
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW+p	MT20	4.0	6.0	Edge	
F	BMVW-1	MT20	4.0	4.0		
G	BMV+p	MT20	3.0	4.0		
H	BMVWV-1	MT20	5.0	8.0	3.50	5.50
I	BMVWV-1	MT20	4.0	9.0		
J	BMVWV-1	MT20	5.0	8.0	3.50	5.50
K	BMV+p	MT20	3.0	4.0		
L	BMVW-1	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	RECORD
JT	VERT	HORIZ	DOWN	HORIZ
L	423	0	423	0
F	423	0	423	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT L, F. MINIMUM BEARING LENGTH AT JOINT L = 1-8, JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	299	198 / 0	0 / 0	0 / 0	0 / 0	103 / 0	0 / 0
F	299	198 / 0	0 / 0	0 / 0	0 / 0	103 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	-282 / 0	-91.8 -91.8	0.05 (1)	I-C	0 / 125	0.03 (1)	
B-C	-274 / 0	-91.8 -91.8	0.07 (1)	I-D	-57 / 0	0.01 (1)	
C-D	-274 / 0	-91.8 -91.8	0.07 (1)	B-I	-57 / 0	0.01 (1)	
D-E	-282 / 0	-91.8 -91.8	0.06 (1)	L-J	-13 / 0	0.00 (1)	
L-A	-404 / 0	0.0 0.0	0.05 (1)	A-J	0 / 317	0.07 (1)	
F-E	-404 / 0	0.0 0.0	0.05 (1)	H-F	-13 / 0	0.00 (1)	
L-K	0 / 9	-18.5 -18.5	0.01 (4)	H-E	0 / 317	0.07 (1)	
K-J	0 / 11	0.0 0.0	0.01 (1)				
J-B	-182 / 0	0.0 0.0	0.01 (1)				
J-I	0 / 247	-18.5 -18.5	0.08 (1)				
I-H	0 / 247	-18.5 -18.5	0.08 (1)				
G-H	0 / 11	0.0 0.0	0.01 (1)				
H-D	-182 / 0	0.0 0.0	0.01 (1)				
G-F	0 / 9	-18.5 -18.5	0.01 (4)				

TOTAL WEIGHT = 2 X 43 = 85 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL = 6.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD = 39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.28")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.07/1.00 (C-D:1), BC=0.06/1.00 (H-I:1), WB=0.07/1.00 (A-J:1), SS=0.08/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMPA=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 788	1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.30 (E) (INPUT = 0.90)
JSI METAL= 0.08 (E) (INPUT = 1.00)

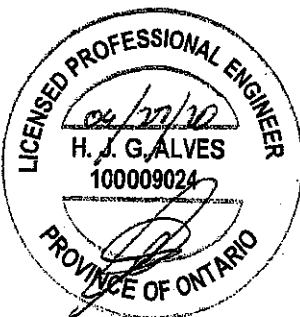

Structural component only
DWG# T-2007076

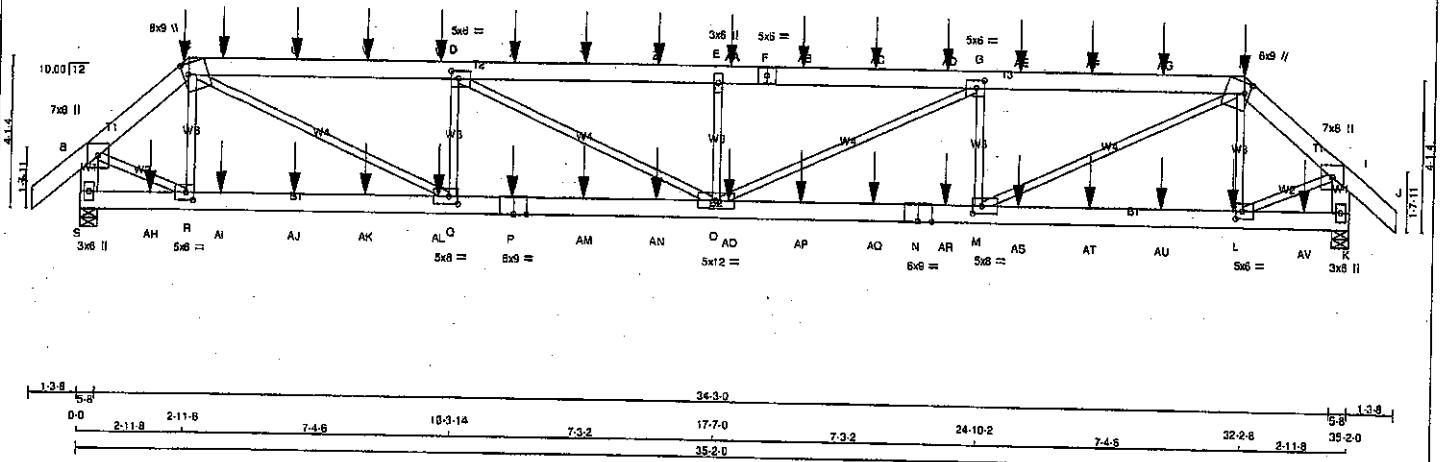

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x8	DRY	No.2	SPF
C - F	2x6	DRY	No.2	SPF
F - H	2x6	DRY	No.2	SPF
H - J	2x6	DRY	No.2	SPF
S - B	2x6	DRY	No.2	SPF
K - I	2x6	DRY	No.2	SPF
S - P	2x6	DRY	1650F 1.5E	SPF
P - N	2x6	DRY	1650F 1.5E	SPF
N - K	2x6	DRY	1650F 1.5E	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C 2 12	SIDE(122.0)	
C-F 2 12	SIDE(81.0)	
F-H 2 12	SIDE(81.0)	
H-J 2 12	SIDE(122.0)	
S-B 2 12	TOP	
K-I 2 12	TOP	
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S-P 2 12	SIDE(0.0)	
P-N 2 12	SIDE(0.0)	
N-K 2 12	SIDE(183.1)	
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	RECORD BRG IN-SX
JT VERT 3330	3330	5-8	5-8
S 3330	3330	5-8	5-8
K 3379	3379	5-8	5-8

UNFACTORED REACTIONS

1ST CASE	MAX/MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
S	2354 1553 / 0 0 / 0 0 / 0 801 / 0 0 / 0
K	2388 1572 / 0 0 / 0 0 / 0 816 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.98 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)
FR-TO	A-B	0 / 42	-91.8	-91.8	0.04 (1)	10.00	R-C	-662 / 0	0.08 (1)
	B-C	-3359 / 0	-91.8	-91.8	0.05 (1)	6.03	C-Q	0 / 4522	0.56 (1)
	C-T	-6608 / 0	-91.8	-91.8	0.38 (1)	4.32	Q-D	-1799 / 0	0.22 (1)
	T-U	-6608 / 0	-91.8	-91.8	0.38 (1)	4.32	D-O	0 / 1375	0.17 (1)
	U-V	-6608 / 0	-91.8	-91.8	0.38 (1)	4.32	O-E	-590 / 0	0.12 (1)
	V-W	-6608 / 0	-91.8	-91.8	0.38 (1)	4.32	E-G	0 / 1368	0.17 (1)
	W-D	-6608 / 0	-91.8	-91.8	0.38 (1)	4.32	M-G	-1785 / 0	0.21 (1)
	D-X	-7835 / 0	-91.8	-91.8	0.42 (1)	3.98	M-H	0 / 4493	0.56 (1)
	X-Y	-7835 / 0	-91.8	-91.8	0.42 (1)	3.98	L-H	-873 / 0	0.08 (1)
	Y-Z	-7835 / 0	-91.8	-91.8	0.42 (1)	3.98	B-R	0 / 2729	0.34 (1)
	Z-E	-7835 / 0	-91.8	-91.8	0.42 (1)	3.98	L-I	0 / 2764	0.34 (1)
	E-AA	-7835 / 0	-91.8	-91.8	0.42 (1)	3.98			
	AA-F	-7835 / 0	-91.8	-91.8	0.42 (1)	3.98			
	F-AB	-7835 / 0	-91.8	-91.8	0.42 (1)	3.98			
	AB-AC	-7835 / 0	-91.8	-91.8	0.42 (1)	3.98			
	AC-AD	-7835 / 0	-91.8	-91.8	0.42 (1)	3.98			
	AD-G	-7835 / 0	-91.8	-91.8	0.42 (1)	3.98			
	G-AE	-6612 / 0	-91.8	-91.8	0.38 (1)	4.32			
	AE-AF	-6612 / 0	-91.8	-91.8	0.38 (1)	4.32			
	AF-AG	-6612 / 0	-91.8	-91.8	0.38 (1)	4.32			
	AG-H	-6612 / 0	-91.8	-91.8	0.38 (1)	4.32			
	H-I	-3401 / 0	-91.8	-91.8	0.05 (1)	6.00			
	I-J	0 / 42	-91.8	-91.8	0.04 (1)	10.00			
	S-B	-3366 / 0	0.0	0.0	0.12 (1)	7.58			
	K-I	-3406 / 0	0.0	0.0	0.12 (1)	7.55			

S-AH	0 / 0	-18.5	-18.5	0.06 (4)	10.00
AH-R	0 / 0	-18.5	-18.5	0.06 (4)	10.00
R-AI	0 / 2546	-18.5	-18.5	0.16 (1)	10.00
AI-AJ	0 / 2546	-18.5	-18.5	0.16 (1)	10.00
AJ-AK	0 / 2546	-18.5	-18.5	0.16 (1)	10.00
AK-AL	0 / 2546	-18.5	-18.5	0.16 (1)	10.00
AL-Q	0 / 2546	-18.5	-18.5	0.16 (1)	10.00
Q-P	0 / 6606	-18.5	-18.5	0.32 (1)	10.00
P-AM	0 / 6606	-18.5	-18.5	0.32 (1)	10.00
AM-AN	0 / 6606	-18.5	-18.5	0.32 (1)	10.00
AN-O	0 / 6606	-18.5	-18.5	0.32 (1)	10.00
O-AQ	0 / 6613	-18.5	-18.5	0.32 (1)	10.00
AQ-AP	0 / 6613	-18.5	-18.5	0.32 (1)	10.00
AP-AQ	0 / 6613	-18.5	-18.5	0.32 (1)	10.00
AQ-N	0 / 6613	-18.5	-18.5	0.32 (1)	10.00
N-AR	0 / 6613	-18.5	-18.5	0.32 (1)	10.00
AR-M	0 / 6613	-18.5	-18.5	0.32 (1)	10.00

TOTAL WEIGHT = 2 X 183 = 365 lb

DESIGN CRITERIA
*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.20")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.38")

CSI: TC=0.42/1.00 (D-E-1), BC=0.32/1.00 (O-Q-1), WB=0.58/1.00 (C-Q-1), SS=0.22/1.00 (C-D-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1997 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.82 (M) (INPUT = 0.90)
JSI METAL= 0.52 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007081 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408151	T20	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 9.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:19:44 2020 Page 2
ID:h2dflgC44wS_E2zqPs_atzllRw-E6s?Xz51NUYObeR4VLHMmiPOqOS:27EXMbZWzNCX

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW+p	MT20	7.0	8.0
C	TTWW+m	MT20	8.0	9.0 3.50 1.75
D	TMWW-l	MT20	5.0	6.0 2.50 2.50
E	TMW+w	MT20	3.0	6.0
F	TS-l	MT20	5.0	6.0
G	TMWW-l	MT20	5.0	6.0 2.50 2.50
H	TTWW+m	MT20	8.0	9.0 3.50 1.75
I	TMVW+p	MT20	7.0	8.0
K	BMV1+p	MT20	3.0	6.0
L	BMWW-l	MT20	5.0	6.0 2.50 2.25
M	BMWW-l	MT20	5.0	8.0 2.50 3.00
N	BS-l	MT20	6.0	9.0
O	BMWWW-l	MT20	5.0	12.0
P	BS-l	MT20	6.0	9.0
Q	BMWW-l	MT20	5.0	8.0 2.50 3.00
R	BMWW-l	MT20	5.0	6.0 2.50 2.25
S	BMV1+p	MT20	3.0	6.0

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	CS1 (LC)	MAX. UNBRAC LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO							
M-AS	0 / 2579	-18.5	-18.5	0.16 (1)	10.00		
AS-AT	0 / 2579	-18.5	-18.5	0.16 (1)	10.00		
AT-AU	0 / 2579	-18.5	-18.5	0.16 (1)	10.00		
AU-L	0 / 2579	-18.5	-18.5	0.16 (1)	10.00		
L-AV	0 / 0	-18.5	-18.5	0.08 (4)	10.00		
AV-K	0 / 0	-18.5	-18.5	0.08 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-11-8	-38	-42	---	FRONT	VERT	DEAD	---	C1
C	2-11-8	-191	-191	---	FRONT	VERT	SNOW	---	C1
H	32-2-8	-38	-42	---	FRONT	VERT	DEAD	---	C1
H	32-2-8	-116	-116	---	FRONT	VERT	TOTAL	---	C1
H	32-2-8	-191	-191	---	FRONT	VERT	SNOW	---	C1
L	31-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
P	11-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
T	3-11-4	-111	-111	---	FRONT	VERT	TOTAL	---	C1
U	5-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	17-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	19-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	21-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	23-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	25-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	27-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AG	29-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AH	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AL	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AM	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AN	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	17-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AP	19-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AQ	21-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AR	23-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AS	25-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AT	27-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AU	29-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AV	33-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007081

JOB NAME 408151	TRUSS NAME T20Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					
Version 2.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:19:45 2020 Page 1					
ID:h2dflgC44ws E2tzoPs_atzIRw-JCOUmko9VL9YAq_n0agaJuZ04EB5KGTB585yzNCX					

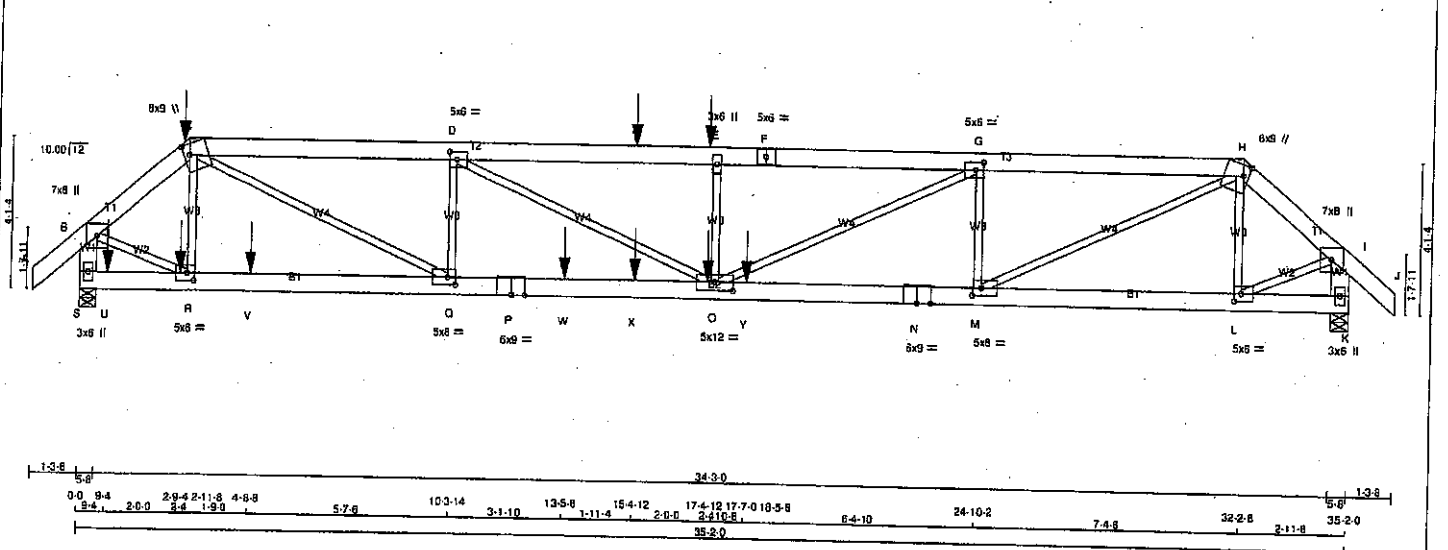

LUMBER	SIZE	DESCR.
N. L. G. A. RULES		
CHORDS		
A - C	2x6 DRY	No.2
C - F	2x6 DRY	No.2
F - H	2x6 DRY	No.2
H - J	2x6 DRY	No.2
S - B	2x6 DRY	No.2
K - I	2x6 DRY	No.2
S - P	2x6 DRY	1650F 1.5E
P - N	2x6 DRY	1650F 1.5E
N - K	2x6 DRY	1650F 1.5E
ALL WEBS	2x3 DRY	No.2
EXCEPT		

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS	#ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS			
A - C	2	12	SIDE(122.0)
C - F	2	12	SIDE(183.1)
F - H	2	12	TOP
H - J	2	12	TOP
S - B	2	12	TOP
K - I	2	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS			
S - P	2	12	SIDE(183.1)
P - N	2	12	SIDE(183.1)
N - K	2	12	TOP
WEBS: (0.122"x3") SPIRAL NAILS			
2x3	1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	UP	IN-SX
S	4991	0	0	5-8
K	3694	0	0	5-8

UNFACTORED REACTIONS	1ST CASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	SNOW
S	3528	2323 / 0
K	2608	1737 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO						FR-TO			
A-B	0 / 42	-91.8	-91.8	0.04 (1)	10.00	R-C	-253 / 44	0.03 (1)	
B-C	5342 / 0	-91.8	-91.8	0.07 (1)	5.02	C-Q	0 / 6589	0.81 (1)	
C-D	-9971 / 0	-91.8	-91.8	0.39 (1)	3.64	Q-D	-1958 / 0	0.23 (1)	
D-E	-12379 / 0	-91.8	-91.8	0.52 (1)	3.20	D-O	0 / 2694	0.33 (1)	
E-F	-12379 / 0	-91.8	-91.8	0.52 (1)	3.20	O-E	-782 / 0	0.09 (1)	
F-G	-12379 / 0	-91.8	-91.8	0.49 (1)	3.23	C-G	0 / 4229	0.52 (1)	
G-H	-8599 / 0	-91.8	-91.8	0.33 (1)	3.93	M-H	-2819 / 0	0.31 (1)	
H-I	-3750 / 0	-91.8	-91.8	0.08 (1)	5.79	L-H	0 / 6416	0.79 (1)	
I-J	0 / 42	-91.8	-91.8	0.04 (1)	10.00	B-R	0 / 4341	0.54 (1)	
S-B	-5197 / 0	0.0	0.0	0.19 (1)	6.41	L-I	0 / 3047	0.38 (1)	
K-I	-3727 / 0	0.0	0.0	0.13 (1)	7.30				
S-U	0 / 0	-18.5	-18.5	0.20 (1)	10.00				
U-R	0 / 0	-18.5	-18.5	0.20 (1)	10.00				
R-V	0 / 4073	-18.5	-18.5	0.38 (1)	10.00				
V-Q	0 / 4073	-18.5	-18.5	0.38 (1)	10.00				
Q-P	0 / 9971	-18.5	-18.5	0.73 (1)	10.00				
P-W	0 / 9971	-18.5	-18.5	0.73 (1)	10.00				
W-X	0 / 9971	-18.5	-18.5	0.73 (1)	10.00				
X-O	0 / 9971	-18.5	-18.5	0.73 (1)	10.00				
O-Y	0 / 8600	-18.5	-18.5	0.58 (1)	10.00				
Y-N	0 / 8600	-18.5	-18.5	0.58 (1)	10.00				
N-M	0 / 8600	-18.5	-18.5	0.58 (1)	10.00				
M-L	0 / 2839	-18.5	-18.5	0.16 (1)	10.00				
L-K	0 / 0	-18.5	-18.5	0.05 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
JT	2-11-8	-38	-42	---	FRONT	VERT	DEAD	---	C1
C	2-11-8	-117	-117	---	BACK	VERT	TOTAL	---	C1
C	2-11-8	-191	-191	---	FRONT	VERT	SNOW	---	C1
E	17-4-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
O	17-4-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
H	2-9-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
T	15-4-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	9-4	-29	-29	---	BACK	VERT	TOTAL	---	C1
V	4-8-8	-1066	-1066	---	BACK	VERT	TOTAL	---	C1
W	13-5-8	-1066	-1066	---	BACK	VERT	TOTAL	---	C1
X	15-4-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
Y	18-5-8	-1738	-1738	---	BACK	VERT	TOTAL	---	C1

TOTAL WEIGHT = 2 X 183 = 365 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:	TOP CH.	LL	PSF
	DL	6.0	PSF
	DL	0.0	PSF
	DL	7.4	PSF
	TOTAL LOAD	39.0	PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(95% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.33")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/685 (0.62")

CSI: TO=0.52/1.00 (D-E:1), BC=0.73/1.00 (O-Q:1), WB=0.81/1.00 (C-Q:1), SSI=0.57/1.00 (M-O:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1657 788	1987 1655

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (D) (INPUT = 0.90)
JSI METAL = 0.84 (P) (INPUT = 1.00)

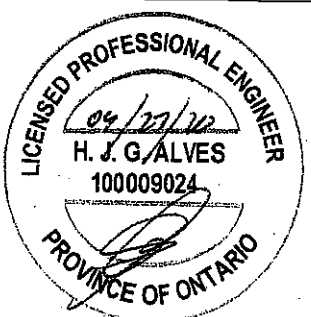

Structural component only
DWG# T-2007082 42

JOB NAME 408151	TRUSS NAME T20Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	


Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 26 11:19:45 2020 Page 2
 ID:h2dfiqC44wS E2lzoPs atzllRw-lJC0Umko9VL9YAq n0agaJuZo4E85KGTB585vzNCX

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	7.0	8.0		
C	TTWW+m	MT20	8.0	9.0	3.50	1.75
D	TMWW-t	MT20	5.0	6.0	2.50	2.50
E	TMW+w	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMWW-t	MT20	5.0	6.0	2.50	2.50
H	TTWW+m	MT20	8.0	9.0	3.50	1.75
I	TMVW+p	MT20	7.0	8.0		
K	BMV1+p	MT20	3.0	5.0		
L	BMWW-t	MT20	5.0	6.0	2.50	2.25
M	BMWW-t	MT20	5.0	6.0	2.50	2.75
N	BS-t	MT20	6.0	9.0		
O	BMWWW-t	MT20	5.0	12.0	2.75	6.00
P	BS-t	MT20	6.0	9.0		
Q	BMWW-t	MT20	5.0	6.0	2.50	2.75
R	BMWW-t	MT20	5.0	6.0	2.50	2.25
S	BMV1+p	MT20	3.0	6.0		

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

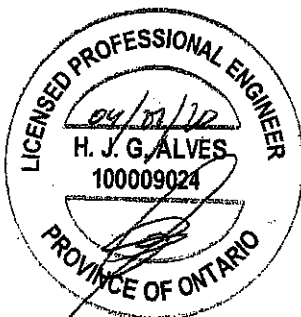


Structural component only
 DWG# T-2007082

Structural component only
DWG# T-2007083

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	ORWG NO.
408151	T22	2	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2018 MiTek Industries, Inc. Sat Apr 25 11:19:47 2020 Page 1
ID:h2dlgC44wS_E2tqPs_atzllRw-ehJB9?n_Kml3PrKD6C22v7OAzcpWf3vZwVaFArZNCXg
35-2-0 36-5-8
Scale = 1/8" = 1'-0"

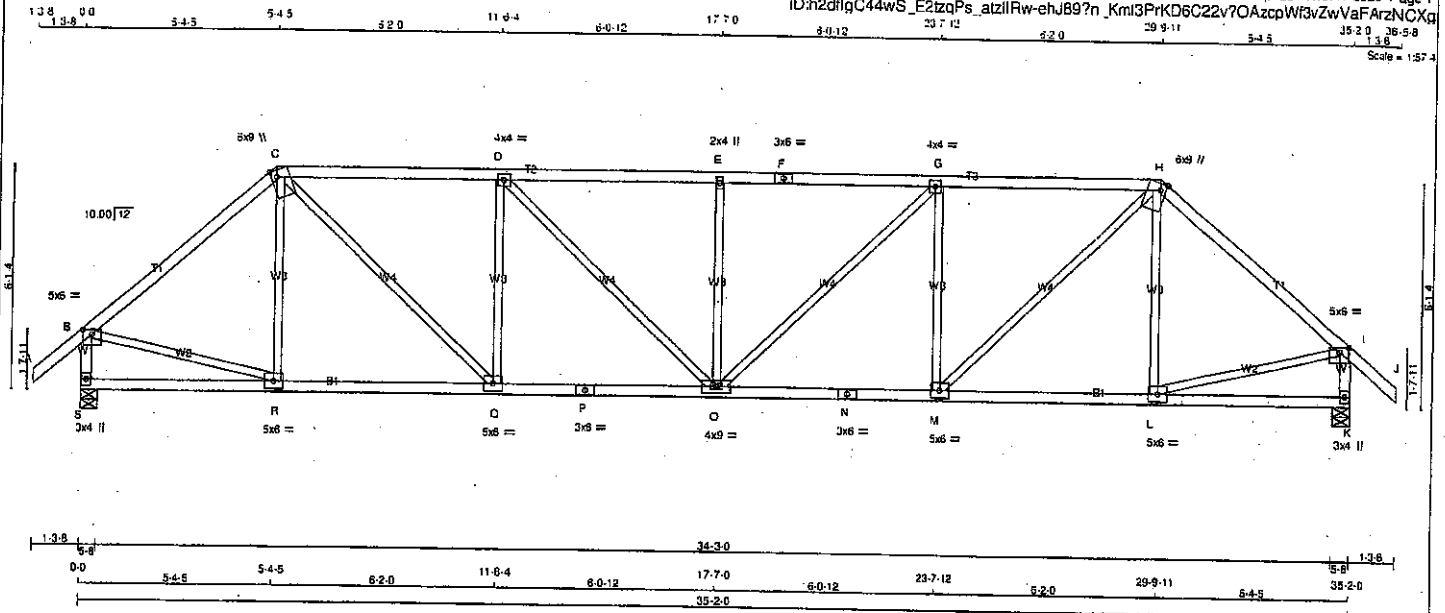

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
J - L	2x4	DRY	No.2
L - K	2x4	DRY	No.2
S - P	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	6.0	1.50	3.00
C TTWW-m	MT20	6.0	9.0	Edge	1.75
D TMWW-t	MT20	4.0	4.0		
E TMW-w	MT20	2.0	4.0		
F TS-t	MT20	3.0	6.0		
G TMWW-t	MT20	4.0	4.0		
H TTWW-m	MT20	6.0	9.0	Edge	1.75
I TMVW-p	MT20	5.0	6.0	1.50	3.00
K BMV1-p	MT20	3.0	4.0		
L, M, Q, R					
L BMWW-t	MT20	5.0	6.0		
N BS-t	MT20	3.0	6.0		
O BMWW-t	MT20	4.0	9.0		
P BS-t	MT20	3.0	6.0		
S BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
S	2068	0	0	2068	0	0	0	5-8	5-8
K	2068	0	0	2068	0	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST CASE	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	1458	971/0	0/0	0/0	0/0	488/0	0/0
S	1458	971/0	0/0	0/0	0/0	488/0	0/0
K	1458	971/0	0/0	0/0	0/0	488/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.28 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED	MEMB.	MAX. FACTORED
FR-TO	FORCE (LBS)	FR-TO	FORCE (LBS)
A-B	0/41	A-C	-246/7
B-C	-2004/0	C-D	0/1538
C-D	-2653/0	D-E	-943/0
D-E	-2978/0	E-F	0/450
E-F	-2978/0	F-G	-513/0
F-G	-2978/0	G-H	0/450
G-H	-2653/0	H-I	-943/0
H-I	-2004/0	I-J	0/1538
I-J	0/41	J-K	-246/7
J-K	-2026/0	K-L	0/1580
K-L	-2026/0	L-M	0/1580
L-M	0/0	M-N	0/1580
M-N	-18.5	N-O	-18.5
N-O	-18.5	O-P	-18.5
O-P	-18.5	P-Q	-18.5
P-Q	-18.5	Q-R	-18.5
Q-R	-18.5	R-S	-18.5
R-S	-18.5	S-T	-18.5
S-T	-18.5	T-U	-18.5
T-U	-18.5	U-V	-18.5
U-V	-18.5	V-W	-18.5
V-W	-18.5	W-X	-18.5
W-X	-18.5	X-Y	-18.5
X-Y	-18.5	Y-Z	-18.5
Y-Z	-18.5	Z-A	-18.5

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.16")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.29")

CSI: TC=0.78/1.00 (D-E:1), BC=0.49/1.00 (C-D:1),
WB=0.55/1.00 (G-H:1), SS=0.27/1.00 (O-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1899

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (B) (INPUT = 0.90)
JSI METAL = 0.85 (N) (INPUT = 1.00)



Structural component only
DWG# T-2007084

Technical drawing of a roof truss structure. The drawing includes a side elevation and a plan view. The side elevation shows a truss with a peak at node D. The roof slope is indicated as 10.00/12. The truss members are labeled with letters (A, B, C, D, E, F, G, H, I, J, K, L, M, N, O, P, Q, R, S, T, U, V, W, X, Y, Z) and numbers (1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52, 53, 54, 55, 56, 57, 58, 59, 60, 61, 62, 63, 64, 65, 66, 67, 68, 69, 70, 71, 72, 73, 74, 75, 76, 77, 78, 79, 80, 81, 82, 83, 84, 85, 86, 87, 88, 89, 90, 91, 92, 93, 94, 95, 96, 97, 98, 99, 100). The plan view shows the layout of the truss with dimensions in feet and inches. The overall length is 34'-3.0". The width is 1'-3.8". The drawing also includes a section cut through the truss, showing the internal structure and the location of the roof and floor joists.

ALL WEBS 2x3 DRY No.2
EXCEPT
DRY; SEASONED LUMBER

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

UNFACTORED REACTIONS

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U. M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	CS1 (LBS)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX. CS1 (LBS)
FR-TO		FROM TO			FR-TO		
A-B	0 / 41	-91.8	-91.8 (1) (1)	10.00	C-T	0 / 156	0.04 (1)
B-C	0 / 19	-91.8	-91.8 (1) (1)	10.00	T-D	0 / 76	0.03 (4)
C-D	-2023 / 0	-91.8	-91.8 (2) (1)	4.59	D-S	0 / 1220	0.27 (1)
D-E	-2308 / 0	-91.8	-91.8 (5) (1)	3.94	S-E	-850 / 0	0.74 (1)
E-F	-2534 / 0	-91.8	-91.8 (5) (1)	3.77	E-Q	0 / 361	0.08 (1)
F-G	-2534 / 0	-91.8	-91.8 (5) (1)	3.77	Q-H	-461 / 0	0.40 (1)
G-H	-2308 / 0	-91.8	-91.8 (5) (1)	3.77	H-I	0 / 381	0.38 (1)
H-I	-2308 / 0	-91.8	-91.8 (5) (1)	3.94	I-J	-850 / 0	0.74 (1)
J-K	-2023 / 0	-91.8	-91.8 (2) (1)	4.59	O-H	0 / 1220	0.27 (1)
K-L	0 / 19	-91.8	-91.8 (1) (1)	10.00	N-I	0 / 76	0.03 (4)
L-M	0 / 41	-91.8	-91.8 (1) (1)	10.00	N-J	0 / 156	0.04 (1)
U-B	-246 / 0	0.0	0.0 (0) (3)	7.81	U-C	-2277 / 0	0.98 (1)
M-K	-246 / 0	0.0	0.0 (0) (3)	7.81	J-M	-2277 / 0	0.98 (1)
U-T	0 / 1433	-18.5	-18.5 (0.33) (1)	10.00			
T-S	0 / 1535	-18.5	-18.5 (0.35) (1)	10.00			
S-R	0 / 2308	-18.5	-18.5 (0.42) (1)	10.00			
R-Q	0 / 2308	-18.5	-18.5 (0.42) (1)	10.00			
Q-P	0 / 2308	-18.5	-18.5 (0.42) (1)	10.00			
P-O	0 / 2308	-18.5	-18.5 (0.42) (1)	10.00			
O-N	0 / 1535	-18.5	-18.5 (0.35) (1)	10.00			
N-M	0 / 1433	-18.5	-18.5 (0.33) (1)	10.00			

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9.
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018 , OBC 2012 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.17")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.13")
ALLOWABLE DEFL.(TL) = $L/360$ (1.17")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.23")

CSI: TC=0.57/1.00 (E-F:1), 8C=0.42/1.00 (O-Q:1),
WB=0.98/1.00 (J-M:1), SSI=0.24/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


MAIL VALUES

	GRIP(DRY)		SHEAR		SECTION	
	(PSI)	(PLI)	(PLI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN	MAX MIN	MAX MIN	MAX MIN
TT20	618 354	1667 788	1987 1656			


LATE PLACEMENT TOL. = 0.250 inches

LATE ROTATION TOL = 5.0 Deg.

SI GRIP= 0.89 (I) (INPUT = 0.90)
SI METAL= 0.72 (P) (INPUT = 1.00)

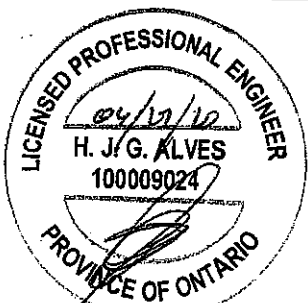

Structural component only
DWG# T-2007085

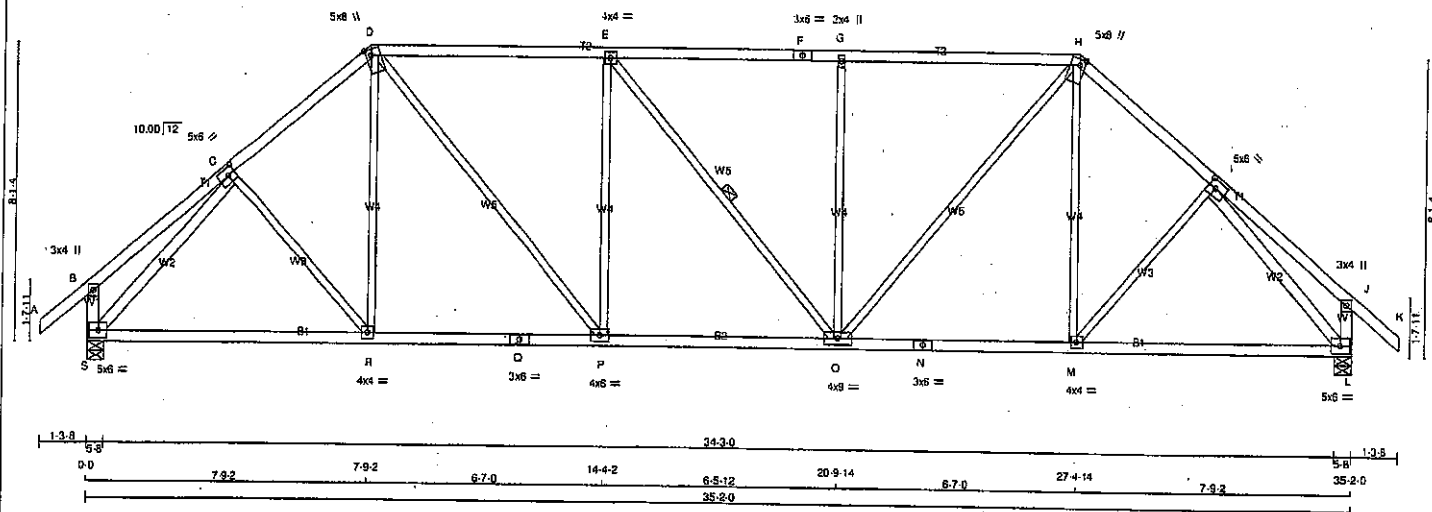

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - K	2x4	DRY	No.2	SPF
S - B	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
S - Q	2x4	DRY	No.2	SPF
Q - N	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
S - C	2x4	DRY	No.2	SPF
I - L	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-i	MT20	5.0	6.0	2.50	2.50
D	TMVW+m	MT20	5.0	6.0	2.00	1.75
E	TMVW-i	MT20	4.0	4.0		
F	TS-i	MT20	3.0	6.0		
G	TMVW+w	MT20	2.0	4.0		
H	TMVW+m	MT20	5.0	6.0	2.00	1.75
I	TMVW-i	MT20	5.0	6.0	2.50	2.50
J	TMV+p	MT20	3.0	4.0		
K	BMVW-i	MT20	5.0	6.0		
M	BS-i	MT20	4.0	4.0		
N	BS-i	MT20	3.0	6.0		
O	BMVW-i	MT20	4.0	4.0		
P	BMVW-i	MT20	4.0	6.0		
Q	BS-i	MT20	3.0	6.0		
R	BMVW-i	MT20	4.0	4.0		
S	BMVW-i	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	VERT	HORZ	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
S	2068	0	2068	0	0	5-8	5-8	5-8	5-8
L	2068	0	2068	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST CASE		MAX/MIN COMPONENT REACTIONS		1ST CASE		MAX/MIN COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.81 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CS (LC)	MAX. UNBRAC	MEMB.	FORCE (LBS)	MAX. CS (LC)	MEMB.	FORCE (LBS)
FR-TO					FR-TO			FR-TO	
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	C-R	0 / 64	0.02 (4)	
B-C	0 / 28	-91.8	-91.8	0.21 (1)	10.00	R-D	0 / 126	0.04 (4)	
C-D	-2008 / 0	-91.8	-91.8	0.29 (1)	4.50	D-P	0 / 998	0.22 (1)	
D-E	-2163 / 0	-91.8	-91.8	0.73 (1)	3.81	P-E	-650 / 0	0.82 (1)	
E-F	-2162 / 0	-91.8	-91.8	0.73 (1)	3.81	E-O	-2 / 0	0.00 (1)	
F-G	-2162 / 0	-91.8	-91.8	0.73 (1)	3.81	O-G	-649 / 0	0.82 (1)	
G-H	-2162 / 0	-91.8	-91.8	0.73 (1)	3.82	O-H	0 / 998	0.22 (1)	
H-I	-2008 / 0	-91.8	-91.8	0.29 (1)	4.50	M-H	0 / 126	0.04 (4)	
I-J	0 / 28	-91.8	-91.8	0.21 (1)	10.00	M-I	0 / 64	0.02 (4)	
J-K	0 / 41	-91.8	-91.8	0.13 (1)	10.00	S-C	-2291 / 0	0.87 (1)	
S-B	-264 / 0	0.0	0.0	0.03 (1)	7.81	I-L	-2291 / 0	0.87 (1)	
L-J	-264 / 0	0.0	0.0	0.03 (1)	7.81				

S-R	0 / 1487	-18.5	-18.5	0.38 (1)	10.00
R-Q	0 / 1519	-18.5	-18.5	0.39 (1)	10.00
Q-P	0 / 1519	-18.5	-18.5	0.39 (1)	10.00
P-O	0 / 2163	-18.5	-18.5	0.42 (1)	10.00
O-N	0 / 1519	-18.5	-18.5	0.39 (1)	10.00
N-M	0 / 1519	-18.5	-18.5	0.39 (1)	10.00
M-L	0 / 1487	-18.5	-18.5	0.38 (1)	10.00

TOTAL WEIGHT = 2 X 163 = 326 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 8.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.10")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.21")

CS: TC=0.73/1.00 (D-E:1), SC=0.42/1.00 (O-P:1), WB=0.97/1.00 (L-1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)		
MAX	MIN	MAX	MIN

MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (I) (INPUT = 0.80)

JSI METAL= 0.56 (I) (INPUT = 1.00)



Structural component only
DWG# T-2007086

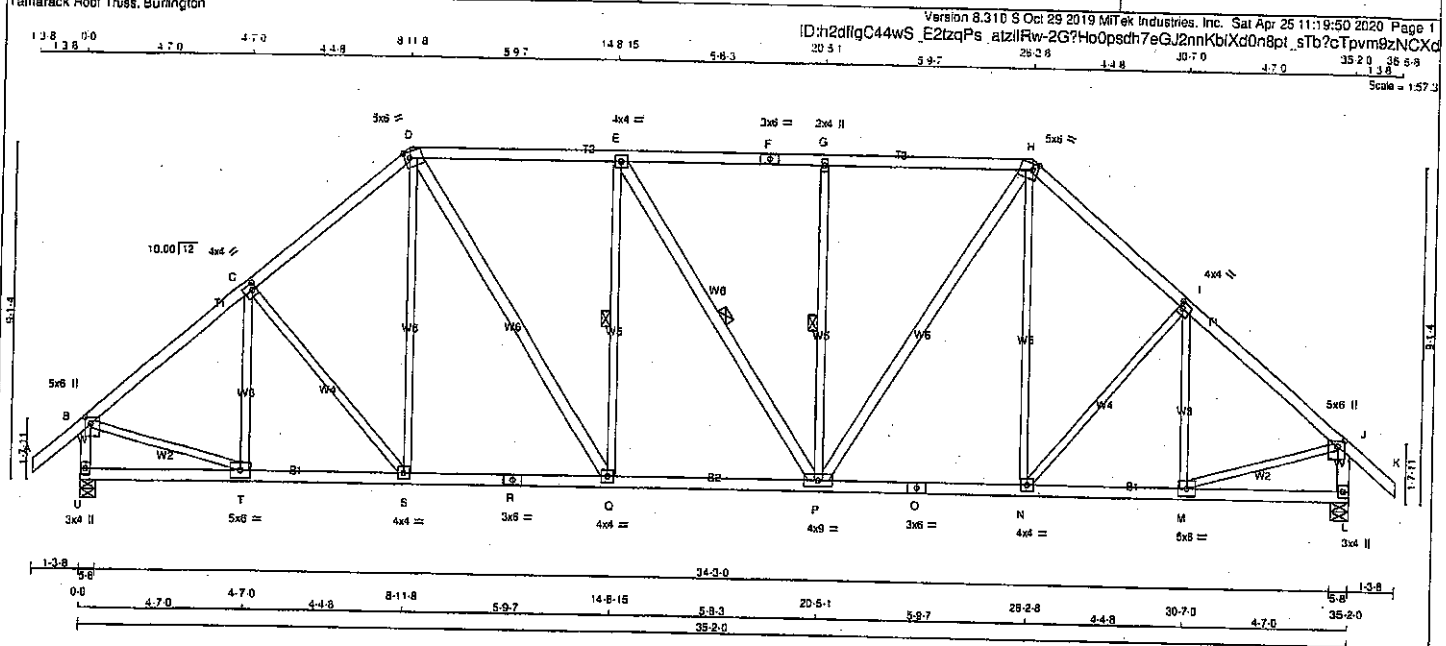

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	NO.2
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2

EXCEPT

D - Q 2x4 DRY No.2

E - P 2x4 DRY No.2

P - H 2x4 DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	8.0	2.00	2.00
C	TMVW-i	MT20	4.0	4.0	2.00	1.25
D	TTWV-m	MT20	5.0	5.0	2.00	1.75
E	TMVW-i	MT20	4.0	4.0		
F	TS-i	MT20	3.0	6.0		
G	TMVW+w	MT20	2.0	4.0		
H	TTWV-m	MT20	5.0	6.0	2.00	1.75
I	TMVW-i	MT20	4.0	4.0	2.00	1.25
J	TMVW+p	MT20	5.0	6.0	2.00	2.00
K	BMV1+p	MT20	3.0	4.0		
L	BMVW-i	MT20	5.0	6.0		
M	BMVW-i	MT20	5.0	6.0		
N	Q, S					
O	BMVW-i	MT20	4.0	4.0		
P	BS-i	MT20	3.0	6.0		
R	BMVW-i	MT20	4.0	6.0		
S	BS-i	MT20	3.0	6.0		
T	BMVW-i	MT20	5.0	6.0		
U	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
U	2066 0	2066 0	5-8	5-8
L	2066 0	2066 0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
U	1458	971 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1458	971 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.44 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, E-P, G-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

MAX. FACTORED				MAX. FACTORED			
MEMB.	FORCE	VERT. LOAD	MAX	MEMB.	FORCE	MAX	
	(LBS)	(PLF)	CSI (LC)		(LBS)	CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	T-C	-357 / 0	0.16 (1)	
B-C	-1994 / 0	-91.8	-91.8 0.30 (1)	C-S	-121 / 0	0.10 (1)	
C-D	-1857 / 0	-91.8	-91.8 0.29 (1)	S-D	0 / 188	0.05 (4)	
D-E	-1923 / 0	-91.8	-91.8 0.40 (1)	D-Q	0 / 810	0.13 (1)	
E-F	-1921 / 0	-91.8	-91.8 0.37 (1)	Q-E	-569 / 0	0.31 (1)	
F-G	-1921 / 0	-91.8	-91.8 0.37 (1)	E-P	-3 / 0	0.00 (1)	
G-H	-1921 / 0	-91.8	-91.8 0.40 (1)	P-G	-568 / 0	0.31 (1)	
H-I	-1957 / 0	-91.8	-91.8 0.29 (1)	P-H	0 / 807	0.13 (1)	
I-J	-1954 / 0	-91.8	-91.8 0.30 (1)	H-N	0 / 189	0.05 (4)	
J-K	0 / 41	-91.8	-91.8 0.13 (1)	N-I	-121 / 0	0.10 (1)	
U-B	-2028 / 0	0.0	0.0 0.22 (1)	M-I	-358 / 0	0.16 (1)	
L-J	-2028 / 0	0.0	0.0 0.22 (1)	B-T	0 / 1617	0.36 (1)	
				M-J	0 / 1617	0.36 (1)	
U-T	0 / 0	-18.5	-18.5 0.08 (4)				
T-S	0 / 1555	-18.5	-18.5 0.30 (1)				
S-R	0 / 1477	-18.5	-18.5 0.30 (1)				
R-Q	0 / 1477	-18.5	-18.5 0.30 (1)				
Q-P	0 / 1923	-18.5	-18.5 0.30 (1)				
P-O	0 / 1478	-18.5	-18.5 0.30 (1)				
O-N	0 / 1478	-18.5	-18.5 0.30 (1)				
N-M	0 / 1555	-18.5	-18.5 0.31 (1)				
M-L	0 / 0	-18.5	-18.5 0.08 (4)				

TOTAL WEIGHT = 2 X 182 = 363 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CSI: TC=0.40/1.00 (D-E:1), BC=0.38/1.00 (P-Q:1), WB=0.38/1.00 (B-T:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1887 1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 0.50 Deg.

JSI GRIP = 0.89 (B) (INPUT = 0.90)
JSI METAL = 0.50 (C) (INPUT = 1.00)

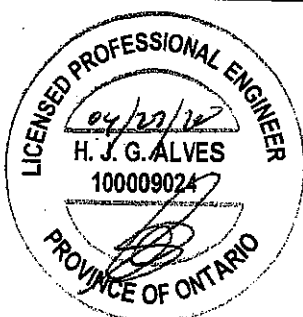

Structural component only
DWG# T-2007087

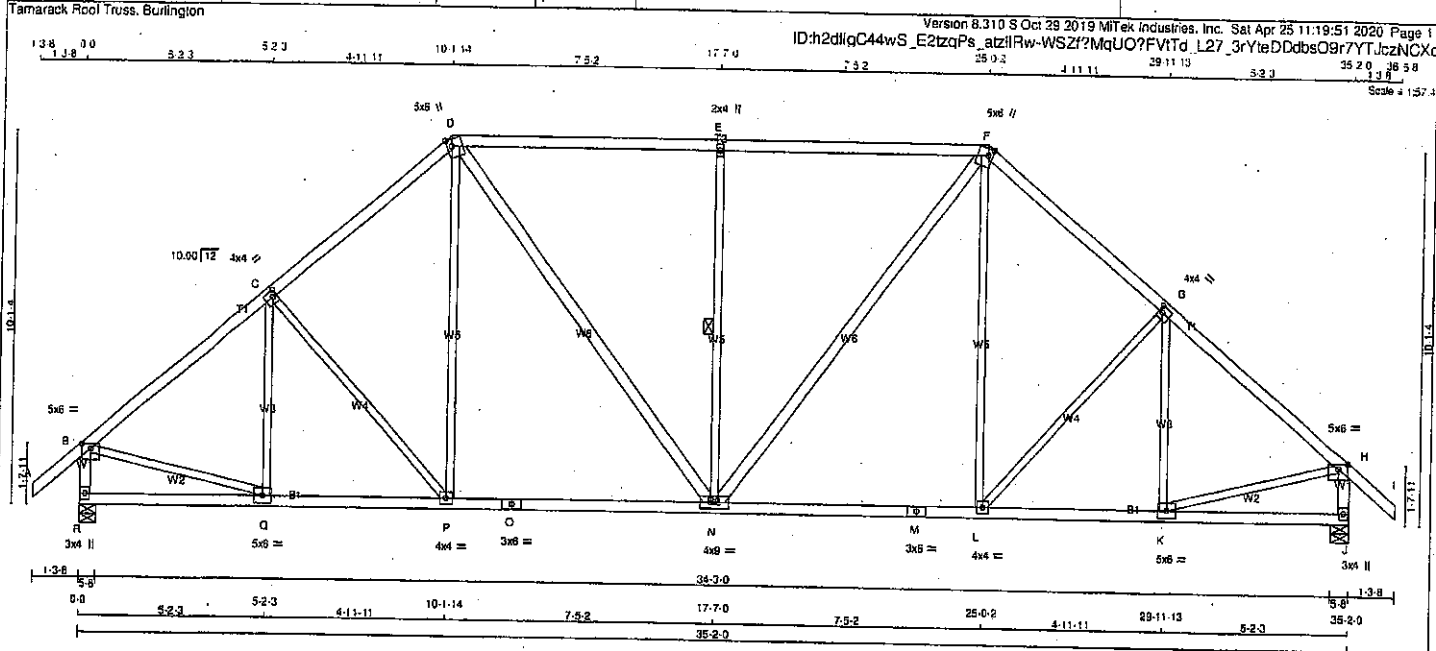

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
A - D	2x4	DRY No.2
D - F	2x4	DRY No.2
F - I	2x4	DRY No.2
I - H	2x4	DRY No.2
H - J	2x4	DRY No.2
J - K	2x4	DRY No.2
K - L	2x4	DRY No.2
L - M	2x4	DRY No.2
M - N	2x4	DRY No.2
N - O	2x4	DRY No.2
O - P	2x4	DRY No.2
P - Q	2x4	DRY No.2
Q - R	2x4	DRY No.2
R - S	2x4	DRY No.2
S - T	2x4	DRY No.2
T - U	2x4	DRY No.2
U - V	2x4	DRY No.2
V - W	2x4	DRY No.2
W - X	2x4	DRY No.2
X - Y	2x4	DRY No.2
Y - Z	2x4	DRY No.2
Z - A	2x4	DRY No.2

ALL WEBS 2x3 DRY No.2

EXCEPT

D - N 2x4 DRY No.2

N - F 2x4 DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.50	3.00
C	TMVW-t	MT20	4.0	4.0	2.00	1.25
D	TTWW-m	MT20	5.0	6.0	2.25	1.50
E	TTWW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.25	1.50
G	TMVW-p	MT20	4.0	4.0	2.00	1.25
H	TMVW-t	MT20	5.0	6.0	1.50	3.00
J	BMVW-p	MT20	3.0	4.0		
K	BMVW-t	MT20	5.0	6.0		
L	BMVW-w	MT20	4.0	4.0		
M	BS-t	MT20	3.0	6.0		
N	BMVW-w	MT20	4.0	4.0		
O	BS-t	MT20	3.0	6.0		
P	BMVW-t	MT20	4.0	4.0		
Q	BMVW-t	MT20	5.0	6.0		
R	BMVW-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT 2068	DOWN 2068	0	5-8
JT HORZ 2068	HORZ 2068	0	5-8
JT UPLIFT 2068	UPLIFT 2068	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS	DEAD	SOIL
JT COMBINED SNOW	LIVE 971/0	0/0	0/0
R COMBINED SNOW	LIVE 971/0	0/0	0/0
J COMBINED SNOW	LIVE 971/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.96 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO	LENGTH	FR-TO		FROM TO	LENGTH
A-B	0/41	-91.8	-91.8 0.13 (1)	10.00	Q-C	-302/0	0.17 (1)
B-C	-2021/0	-91.8	-91.8 0.39 (1)	4.41	C-P	-217/0	0.25 (1)
C-D	-1908/0	-91.8	-91.8 0.37 (1)	4.52	P-D	0/278	0.06 (1)
D-E	-1809/0	-91.8	-91.8 0.74 (1)	3.98	D-N	0/615	0.10 (1)
E-F	-1809/0	-91.8	-91.8 0.74 (1)	3.98	N-E	-838/0	0.58 (1)
F-G	-1808/0	-91.8	-91.8 0.37 (1)	4.52	N-F	0/615	0.10 (1)
G-H	-2021/0	-91.8	-91.8 0.39 (1)	4.41	L-F	0/278	0.06 (1)
H-I	0/41	-91.8	-91.8 0.13 (1)	10.00	L-G	-217/0	0.25 (1)
I-B	-2024/0	0.0	0.0 0.22 (1)	5.94	K-G	-302/0	0.17 (1)
J-H	-2024/0	0.0	0.0 0.22 (1)	5.94	B-Q	0/1829	0.37 (1)
					K-H	0/1829	0.37 (1)
R-Q	0/0	-18.5	-18.5 0.10 (4)	10.00			
Q-P	0/1580	-18.5	-18.5 0.34 (1)	10.00			
P-O	0/1437	-18.5	-18.5 0.35 (1)	10.00			
O-N	0/1437	-18.5	-18.5 0.35 (1)	10.00			
N-M	0/1437	-18.5	-18.5 0.35 (1)	10.00			
M-L	0/1437	-18.5	-18.5 0.35 (1)	10.00			
L-K	0/1580	-18.5	-18.5 0.34 (1)	10.00			
K-J	0/0	-18.5	-18.5 0.10 (4)	10.00			

TOTAL WEIGHT = 4 X 173 = 692 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")

CALCULATED VERT. DEFL.(LL) = L/999 (0.08")

ALLOWABLE DEFL.(TL) = L/360 (1.17")

CALCULATED VERT. DEFL.(TL) = L/999 (0.17")

CSI: TC=0.74/1.00 (D-E:1), BC=0.35/1.00 (L-N:1), WB=0.58/1.00 (E-N:1), SS=0.33/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (B) (INPUT = 0.90)

JSI METAL = 0.46 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007088

JOB NAME 408151	TRUSS NAME T27	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 28 2019 Mitek Industries, Inc. Sat Apr 25 11:19:53 2020 Page 1	
ID:h2dfqC44wS_E2tzgPs_atzllRw-TrgPQ2slvcVC7mmMST9S9GeHs1uT3o2SIR1ZNUzNCXa				23 9 11 29 4 10 35 2 0 35 5 8 1 1 3 8	

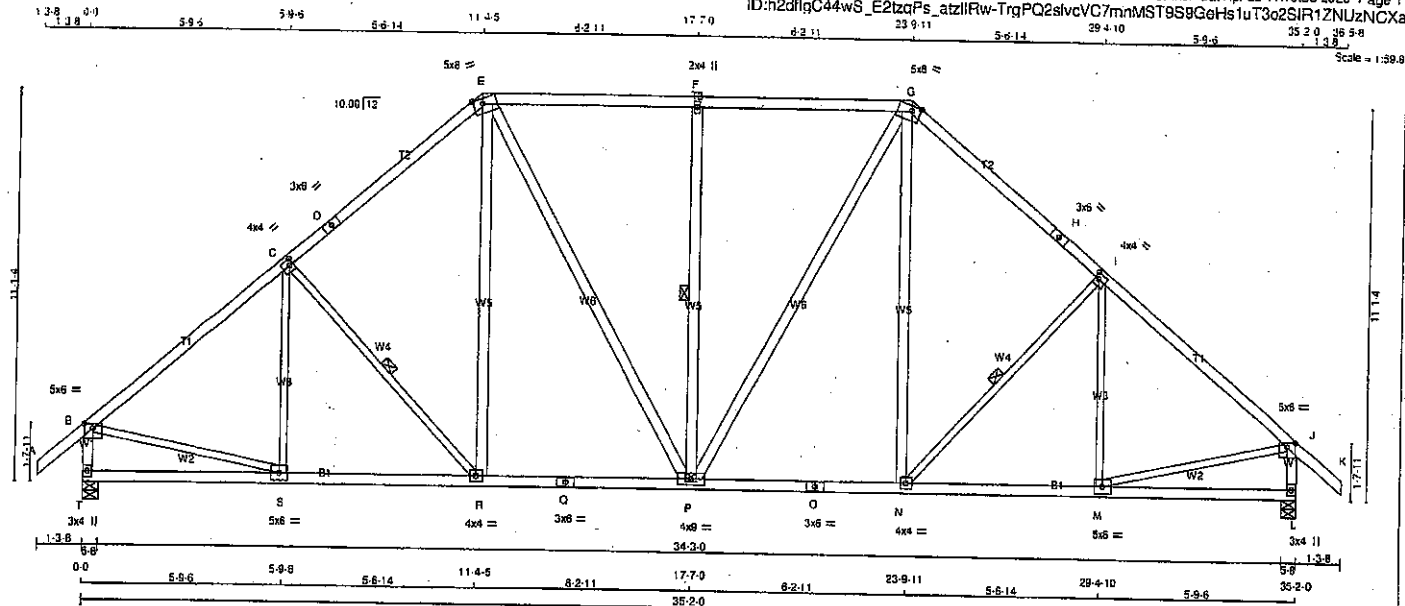

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	DRY	No.2
A - D	2x4	DRY	No.2	
D - E	2x4	DRY	No.2	
E - G	2x4	DRY	No.2	
G - H	2x4	DRY	No.2	
H - K	2x4	DRY	No.2	
T - B	2x4	DRY	No.2	
L - J	2x4	DRY	No.2	
T - Q	2x4	DRY	No.2	
Q - O	2x4	DRY	No.2	
O - L	2x4	DRY	No.2	

ALL WEBS EXCEPT	2x4	DRY	No.2	
S - C	2x3	DRY	No.2	
C - R	2x3	DRY	No.2	
N - I	2x3	DRY	No.2	
M - I	2x3	DRY	No.2	
B - S	2x3	DRY	No.2	
M - J	2x3	DRY	No.2	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMWV-p	MT20	5.0	6.0	1.50	3.00
C TMWV-t	MT20	4.0	4.0	2.00	1.25
D TS-t	MT20	3.0	6.0		
E TTWV-m	MT20	5.0	8.0	Edge	3.00
F TMWV-w	MT20	2.0	4.0		
G TTWV-m	MT20	5.0	8.0	Edge	3.00
H TS-t	MT20	3.0	6.0		
I TMWV-t	MT20	4.0	4.0	2.00	1.25
J TMWV-p	MT20	5.0	6.0	1.50	3.00
K BMWV-t	MT20	3.0	4.0		
M BMWV-t	MT20	5.0	6.0		
N BMWV-t	MT20	4.0	4.0		
O BS-t	MT20	3.0	6.0		
P BMWVW-t	MT20	4.0	4.0		
Q BS-t	MT20	3.0	6.0		
R BMWV-t	MT20	4.0	4.0		
S BMWV-t	MT20	5.0	6.0		
T BMWV-t	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	HORZ	DOWN	HORZ	UPLIFT
T	2068	0	2068	0
L	2068	0	2068	0

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS	WIND	DEAD	SOIL
JT COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
T	1458	971 / 0	0 / 0	0 / 0	488 / 0
L	1458	971 / 0	0 / 0	0 / 0	488 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.27 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-R, F-P, I-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LG1 MAX (PLF)	CS1 (LG) UNBRAC	MEMB. FORCE (LBS)
FR-TO		FROM TO	LENGTH FR-TO	
A-B	0 / 41	-91.8 -91.8	0.13 (1)	10.00
B-C	-2039 / 0	-91.8 -91.8	0.50 (1)	4.27
C-D	-1844 / 0	-91.8 -91.8	0.46 (1)	4.47
D-E	-1844 / 0	-91.8 -91.8	0.46 (1)	4.47
E-F	-1621 / 0	-91.8 -91.8	0.50 (1)	4.60
F-G	-1621 / 0	-91.8 -91.8	0.50 (1)	4.60
G-H	-1844 / 0	-91.8 -91.8	0.46 (1)	4.47
H-I	-1844 / 0	-91.8 -91.8	0.46 (1)	4.47
I-J	-2039 / 0	-91.8 -91.8	0.50 (1)	4.27
J-K	0 / 41	-91.8 -91.8	0.13 (1)	10.00
T-B	-2021 / 0	0.0 0.0	0.21 (1)	5.94
L-J	-2021 / 0	0.0 0.0	0.21 (1)	5.94
T-S	0 / 0	-18.5 -18.5	0.14 (4)	10.00
S-R	0 / 1597	-18.5 -18.5	0.33 (1)	10.00
R-Q	0 / 1387	-18.5 -18.5	0.30 (1)	10.00
Q-P	0 / 1387	-18.5 -18.5	0.30 (1)	10.00
P-O	0 / 1387	-18.5 -18.5	0.30 (1)	10.00
O-N	0 / 1387	-18.5 -18.5	0.30 (1)	10.00
N-M	0 / 1597	-18.5 -18.5	0.33 (1)	10.00
M-L	0 / 0	-18.5 -18.5	0.14 (4)	10.00

TOTAL WEIGHT = 2 X 190 = 380 Lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL = 6.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.07')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.14')

CS1: TC=0.50/1.00 (E-F:1), BC=0.33/1.00 (M-N:1), WB=0.45/1.00 (F-P:1), SS1=0.28/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.89 (J) (INPUT = 0.90)
JSI METAL= 0.47 (O) (INPUT = 1.00)

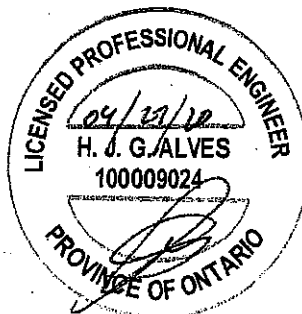

Structural component only
DWG# T-2007089

CONTINUED ON PAGE 2


Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:19:54 2020 Page 1



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408151	T29	1	1	GREEN-PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Ccl 29 2019 MTEK Industries, Inc. Sat Apr 25 11:19:55 2020 Page 1
ID:h2dfiqC44ws_E2z0Ps_atzllRw-PEoArk?RelwM4xlatBwEhig9qdOXaSkmlWqSNzNCXY

Scale = 1:34.7

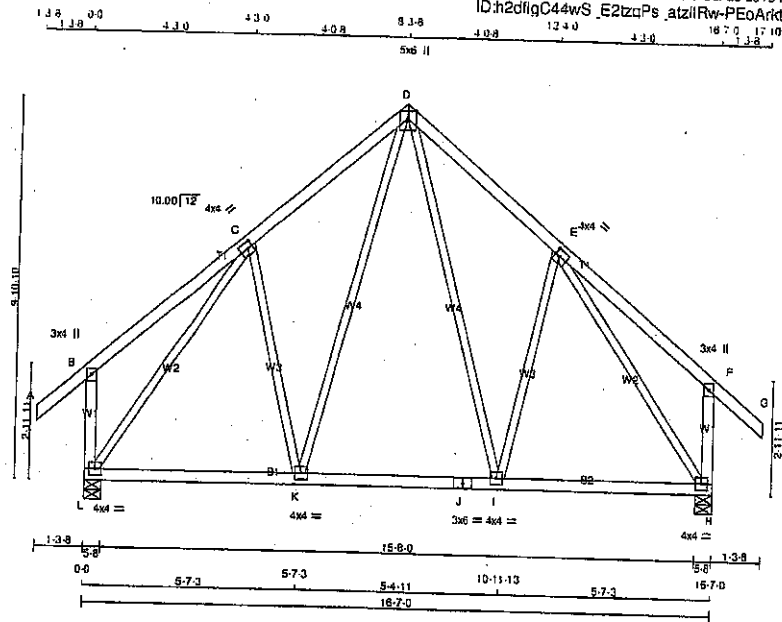

TOTAL WEIGHT = 91 lb
(M/F)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4 DRY	No.2		
D - G	2x4 DRY	No.2		
L - S	2x4 DRY	No.2		
H - F	2x4 DRY	No.2		
L - J	2x4 DRY	No.2		
J - H	2x4 DRY	No.2		

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMWW-1	MT20	4.0	4.0	2.00	1.50
D TTWW+p	MT20	5.0	6.0	Edge	
E TMWW-1	MT20	4.0	4.0	2.00	1.50
F TMV+p	MT20	3.0	4.0		
H BMWW-1	MT20	4.0	4.0		
I BMWW-1	MT20	4.0	4.0		
J BS-1	MT20	3.0	6.0		
K BMWW-1	MT20	4.0	4.0		
L BMWW-1	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
L	1041	0	1041	0
H	1041	0	1041	0

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN COMPONENT REACTIONS	SNOW	LIVE	PERM/LIVE	WIND	DEAD	SOIL
L	734	495 / 0	0 / 0	0 / 0	0 / 0	0 / 0	239 / 0	0 / 0
H	734	495 / 0	0 / 0	0 / 0	0 / 0	0 / 0	239 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 3.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	D-I	0 / 254	0.06 (1)
B-C	0 / 28	-91.8	-91.8 0.28 (1)	10.00	I-E	-138 / 14	0.10 (1)
C-D	-633 / 0	-91.8	-91.8 0.20 (1)	6.25	K-D	0 / 254	0.06 (1)
D-E	-633 / 0	-91.8	-91.8 0.20 (1)	6.25	C-K	-138 / 14	0.10 (1)
E-F	0 / 28	-91.8	-91.8 0.28 (1)	10.00	L-C	-875 / 0	0.90 (1)
F-G	0 / 41	-91.8	-91.8 0.13 (1)	10.00	E-H	-875 / 0	0.90 (1)
L-B	-276 / 0	0.0	0.0 0.04 (1)	7.81			
H-F	-276 / 0	0.0	0.0 0.04 (1)	7.81			
L-K	0 / 495	-18.5	-18.5 0.17 (4)	10.00			
K-J	0 / 395	-18.5	-18.5 0.16 (4)	10.00			
J-I	0 / 395	-18.5	-18.5 0.16 (4)	10.00			
I-H	0 / 495	-18.5	-18.5 0.17 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 089-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.55")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.02")
ALLOWABLE DEFL.(TL) = $L/360$ (0.55")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.04")

CSI: TO=0.26/1.00 (E-F:1), SC=0.17/1.00 (K-L:4),
WB=0.90/1.00 (E-H:1), SS=0.14/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1667 788 1987 1655

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.88 (E) (INPUT = 0.90)
JSI METAL= 0.34 (C) (INPUT = 1.00)

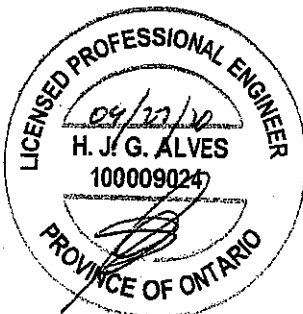

Structural component only
DWG# T-2007091

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408151	T30	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:19:56 2020 Page 1	

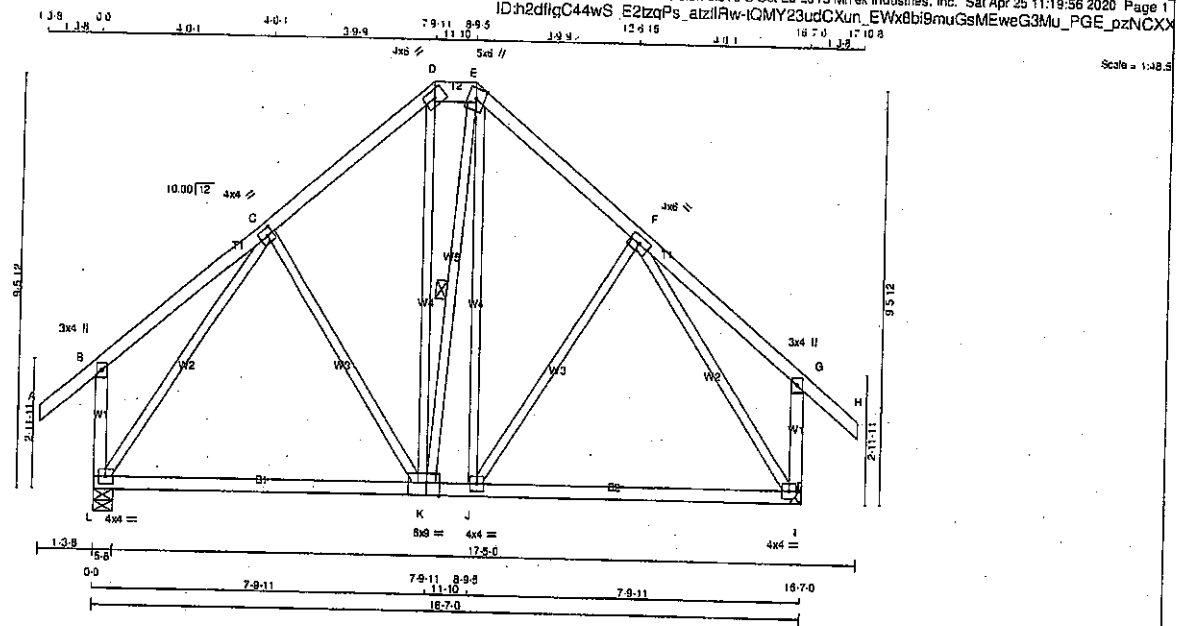

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x6	DRY	No.2
E - H	2x4	DRY	No.2
L - B	2x4	DRY	No.2
I - G	2x4	DRY	No.2
L - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (tables in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-i	MT20	4.0	4.0	2.00	1.75
D	TTW-h	MT20	4.0	6.0		
E	TTWW+m	MT20	5.0	6.0	Edge	
F	TMWW-i	MT20	4.0	6.0		
G	TMV+p	MT20	3.0	4.0		
I	BMVW1-i	MT20	4.0	4.0		
J	BMWW-i	MT20	4.0	4.0		
K	BSWWW-i	MT20	6.0	9.0	Edge	3.75
L	BMVW1-i	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
L	1041	0	1041	0
I	1041	0	1041	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS
	COMBINED	SNOW	LIVE
L	734	485 / 0	0 / 0
I	734	485 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)
FR-TO				FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	C-K	-98 / 9		0.09 (1)
B-C	0 / 27	-91.8	-91.8 0.23 (1)	K-D	0 / 164		0.04 (1)
C-D	-586 / 0	-91.8	-91.8 0.18 (1)	K-E	-109 / 0		0.07 (4)
D-E	-414 / 0	-91.8	-91.8 0.01 (1)	J-E	0 / 268		0.07 (4)
E-F	-582 / 0	-91.8	-91.8 0.18 (1)	J-F	-93 / 15		0.09 (1)
F-G	0 / 27	-91.8	-91.8 0.23 (1)	L-C	-848 / 0		0.78 (1)
G-H	0 / 41	-91.8	-91.8 0.13 (1)	F-I	-832 / 0		0.79 (1)
L-B	-265 / 0	0.0	0.0 0.04 (1)				
I-G	-265 / 0	0.0	0.0 0.04 (1)				
L-K	0 / 488	-18.5	-18.5 0.36 (4)				
K-J	0 / 424	-18.5	-18.5 0.30 (4)				
J-I	0 / 477	-18.5	-18.5 0.30 (4)				

TOTAL WEIGHT = 97 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.55")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.55")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.17")

CSI: TC=0.23/1.00 (B-C-1), BC=0.36/1.00 (K-L-4), WB=0.79/1.00 (F-I-1), SSI=0.14/1.00 (J-K-4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	618	354
	1667	768
	1667	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.89 (C) (INPUT = 0.90)
JSI METAL=0.31 (C) (INPUT = 1.00)

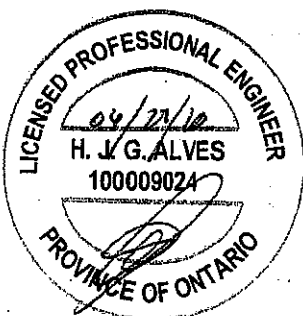

Structural component only
DWG# T-2007092

JOB NAME 408151	TRUSS NAME T31	QUANTITY 1	PLY 1	JOB DESC GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

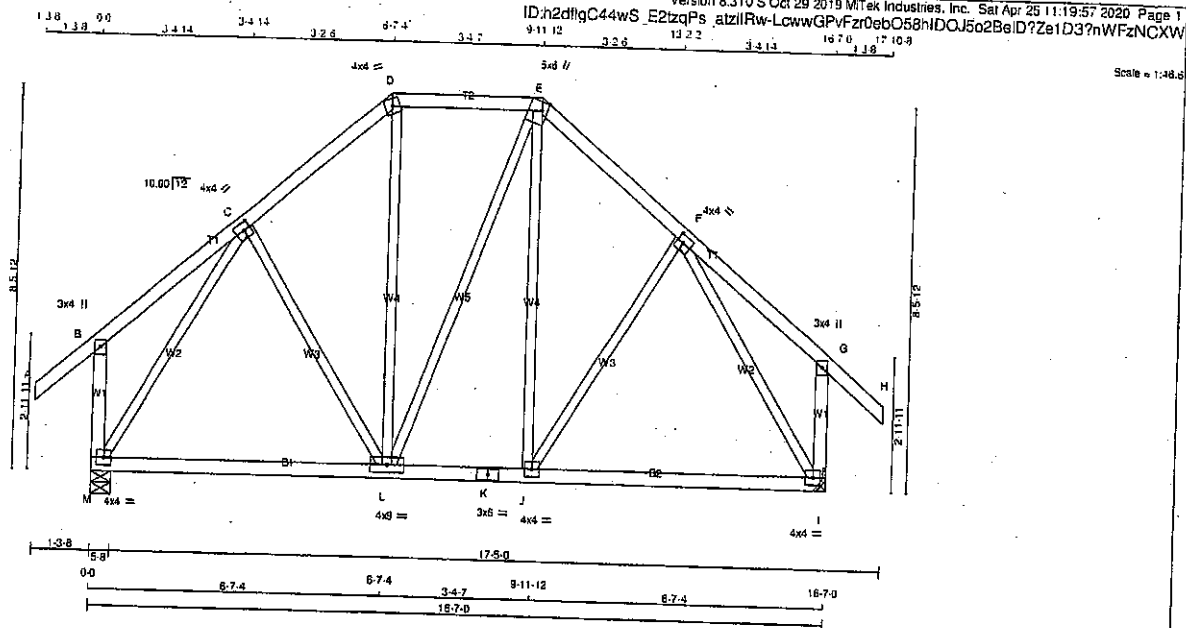

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - H	2x4	DRY	No.2
M - B	2x4	DRY	No.2
I - G	2x4	DRY	No.2
M - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVap	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	4.0	2.00	1.75
D	TTW-m	MT20	4.0	4.0		
E	TTWW+m	MT20	5.0	6.0	2.25	1.50
F	TMWW-t	MT20	4.0	4.0	2.00	1.75
G	TMVap	MT20	3.0	4.0		
I	BMVW-t	MT20	4.0	4.0		
J	BMVW-t	MT20	4.0	4.0		
K	BS-t	MT20	3.0	6.0		
L	BMVW-t	MT20	4.0	4.0		
M	BMVW-t	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
	VERT	DOWN	BRG	BRG
JT	1041	0	0	0
SPF	1041	0	0	0
SPF	1041	0	0	0
SPF	1041	0	0	0
SPF	1041	0	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS

1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	734	495 / 0	0 / 0	0 / 0	0 / 0	239 / 0	0 / 0
I.	734	495 / 0	0 / 0	0 / 0	0 / 0	239 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD	LC1 MAX
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 41	-91.8	-91.8 0.13 (1)	C-L	-10 / 34	0.01 (4)	0.01 (4)
B-C	0 / 22	-91.8	-91.8 0.16 (1)	L-D	0 / 110	0.03 (4)	0.03 (4)
C-D	-813 / 0	-91.8	-91.8 0.13 (1)	L-E	0 / 0	0.00 (1)	0.00 (1)
D-E	-453 / 0	-91.8	-91.8 0.14 (1)	J-E	0 / 109	0.03 (4)	0.03 (4)
E-F	-812 / 0	-91.8	-91.8 0.13 (1)	J-F	-11 / 34	0.01 (4)	0.01 (4)
F-G	0 / 22	-91.8	-91.8 0.16 (1)	M-C	-873 / 0	0.60 (1)	0.60 (1)
G-H	0 / 41	-91.8	-91.8 0.13 (1)	F-I	-873 / 0	0.60 (1)	0.60 (1)
H-B	-245 / 0	0.0	0.0 0.04 (1)				
I-G	-245 / 0	0.0	0.0 0.04 (1)				
M-L	0 / 457	-18.5	-18.5 0.21 (4)				
L-K	0 / 453	-18.5	-18.5 0.20 (4)				
K-J	0 / 453	-18.5	-18.5 0.20 (4)				
J-I	0 / 457	-18.5	-18.5 0.21 (4)				

TOTAL WEIGHT = 92 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
BOT CH.	LL	= 6.0	PSF
	DL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.55")
CALCULATED VERT. DEFL.(TL) = L/999 (0.07")

CSI: TC=0.16/1.00 (F-G:1), BC=0.21/1.00 (E-J:4), WB=0.60/1.00 (C-M:1), SS=0.12/1.00 (D-E:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.87 (C) (INPUT = 0.90)
JSI METAL= 0.31 (C) (INPUT = 1.00)

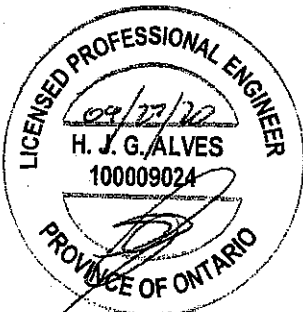

Structural component only
DWG# T-2007093

JOB NAME 408151	TRUSS NAME T32	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:19:58 2020 Page 1
ID:h2dlfgC44wS_E2zqPs_atzilRw-ppUtiWk98VDYgKF0drJL8l2f0k808SjK2izNCXV

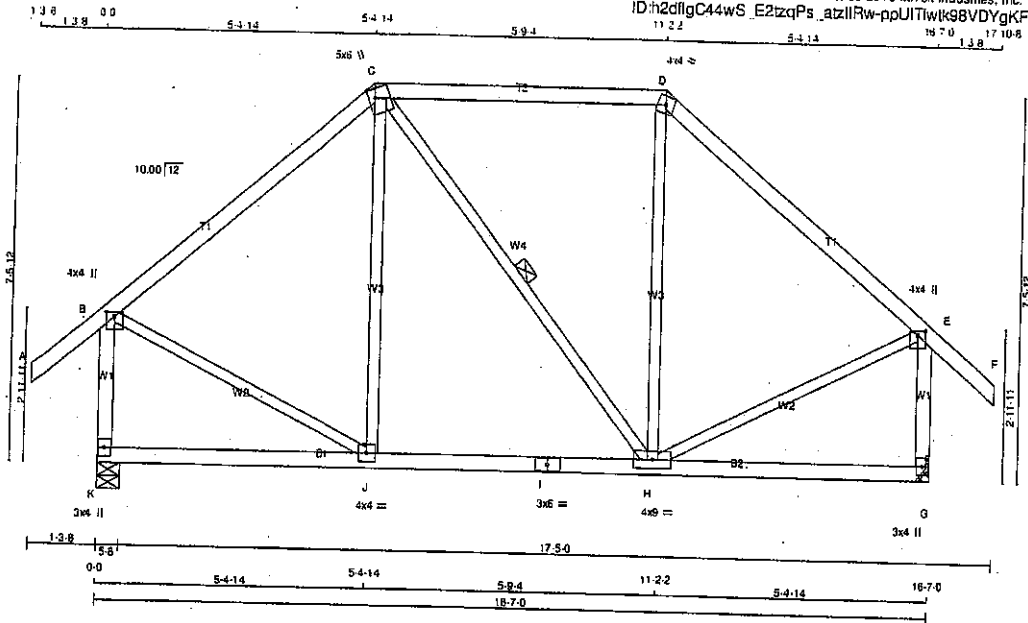

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESOR.
CHORDS			
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
G - E	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTWW+m	MT20	5.0	8.0	2.25	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMVW+p	MT20	4.0	4.0	1.00	2.00
G	BMV1+p	MT20	3.0	4.0		
H	BMVWW-t	MT20	4.0	6.0		
I	BS-t	MT20	3.0	6.0		
J	BMVWW-t	MT20	4.0	4.0		
K	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG	
K	VERT	DOWN	HORIZ	UPLIFT	IN-SX
G	1041	0	1041	0	5-8
					MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
K	COMBINED	SNOW	LIVE			
G	734	495 / 0	0 / 0	0 / 0	239 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLINE SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-H.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
A-B	0 / 41	-91.8	-91.8 0.13 (1)	J-C	-115 / 46
B-C	-918 / 0	-91.8	-91.8 0.35 (1)	C-H	0 / 0
C-D	-473 / 0	-91.8	-91.8 0.39 (1)	H-D	-115 / 46
D-E	-918 / 0	-91.8	-91.8 0.35 (1)	B-J	0 / 526
E-F	0 / 41	-91.8	-91.8 0.13 (1)	H-E	0 / 526
K-B	-1000 / 0	0.0	0.0 0.18 (1)		
G-E	-1000 / 0	0.0	0.0 0.16 (1)		
K-J	0 / 0	-18.5	-18.5 0.13 (4)		
J-I	0 / 473	-18.5	-18.5 0.17 (4)		
I-H	0 / 473	-18.5	-18.5 0.17 (4)		
H-G	0 / 0	-18.5	-18.5 0.13 (4)		

TOTAL WEIGHT = 79 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 5.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.55")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.39/1.00 (C-D:1), BC=0.17/1.00 (H-J:4), WB=0.12/1.00 (B-J:1), SSI=0.21/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1997 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.82 (B) (INPUT = 0.90)
JSI METAL= 0.23 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007094

JOB NAME: 408151 TRUSS NAME: G33 QUANTITY: 1 PLY: 1 JOB DESC: GREEN PARK HOMES TRUSS DESC: Tamarack Roof Truss, Burlington DRWG NO. ID:h2dfgC44wS E2bzqPs atzIRw-LLOVhbzbzdz23nlsCEQP7Wb90nX9W01XJvONQkzNCXn

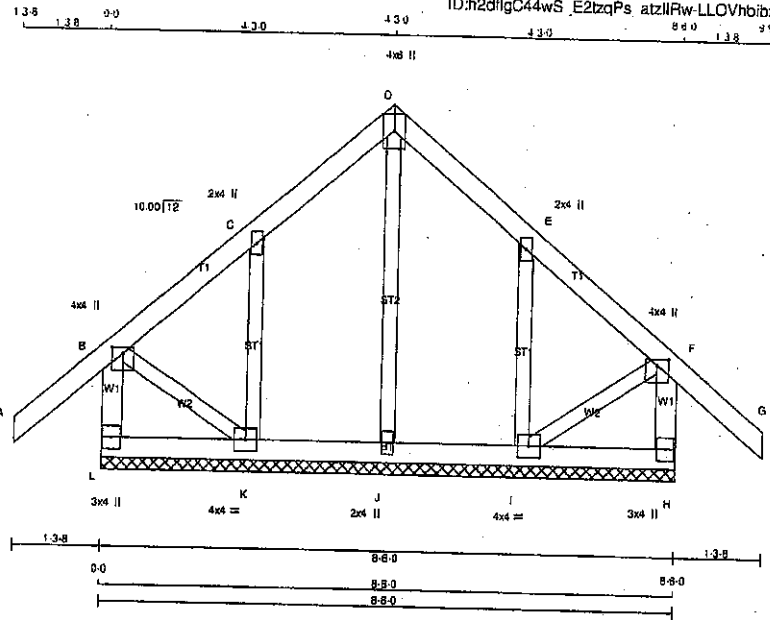

TOTAL WEIGHT = 42 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
L - B	2x4	DRY	No.2	SPF
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
L - H	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
ALL GABLE WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

GABLE STUDS SPACED AT 2'-0\"/>

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TMW+w	MT20	2.0	4.0		
D	TTW+p	MT20	4.0	6.0	Edge	
E	TMW+w	MT20	2.0	4.0		
F	TMVW+p	MT20	4.0	4.0	1.00	2.00
H	BMV1+p	MT20	3.0	4.0		
I	BMWV1+p	MT20	4.0	4.0		
J	BMW1+w	MT20	2.0	4.0		
K	BMWV1+p	MT20	4.0	4.0		
L	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX	UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX
FR-TO	FROM	TO	CSI (LC)	UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX	CSI (LC)	
L-B	-231 / 0	0.0	0.0	0.02 (1)	7.81	J-D	-123 / 0	0.05 (1)	
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	K-C	-236 / 0	0.05 (1)	
B-C	-11 / 0	-91.8	-91.8	0.07 (1)	6.25	I-E	-236 / 0	0.05 (1)	
C-D	-32 / 0	-91.8	-91.8	0.07 (1)	6.25	B-K	0 / 23	0.01 (1)	
D-E	-32 / 0	-91.8	-91.8	0.07 (1)	6.25	I-F	0 / 23	0.01 (1)	
E-F	-11 / 0	-91.8	-91.8	0.07 (1)	6.25				
F-G	0 / 41	-91.8	-91.8	0.13 (1)	10.00				
H-F	-231 / 0	0.0	0.0	0.02 (1)	7.81				
L-K	0 / 0	-18.5	-18.5	0.02 (4)	10.00				
K-J	0 / 13	-18.5	-18.5	0.02 (4)	10.00				
J-I	0 / 13	-18.5	-18.5	0.02 (4)	10.00				
I-H	0 / 0	-18.5	-18.5	0.02 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 085-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (F-G:1), BC=0.02/1.00 (J-K:4), WB=0.05/1.00 (C-K:1), SS=0.08/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1687
	788	1987	1856


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (C) (INPUT = 0.90)
JSI METAL= 0.13 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007078

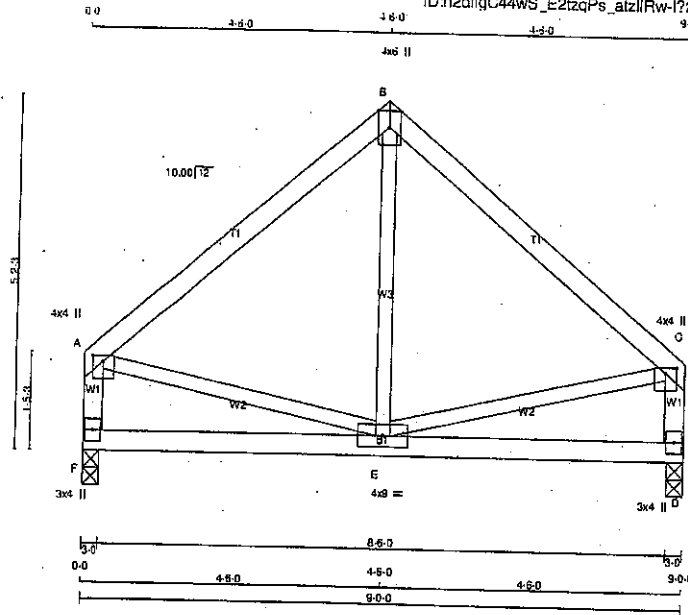

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4 DRY	No.2			
B - C	2x4 DRY	No.2			
F - A	2x4 DRY	No.2			
D - C	2x4 DRY	No.2			
F - D	2x4 DRY	No.2			
ALL WEBS EXCEPT	2x3 DRY	No.2			

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A - B	TMVW+p	MT20	4.0	4.0	1.00	2.00
B - C	TTW+p	MT20	4.0	6.0	Edge	
C - D	TMVW+p	MT20	4.0	4.0	1.00	2.00
D - E	BMV1+p	MT20	3.0	4.0		
E - F	BMV1+p	MT20	4.0	9.0		
F - G	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	UPLIFT	IN-SX
F	496	0	0	3-0
D	496	0	0	3-0

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
JT COMBINED	SNOW	LIVE	PERM.LIVE	
F	351	230 / 0	0 / 0	0 / 0
D	351	230 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PL)	MAX. FACTORED VERT. LOAD LC1 (PL)	MAX. FACTORED HORIZ. LOAD LC1 (PL)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD LC1 (PL)
FR-TO						FR-TO		
A-B	-311 / 0	-91.8	-91.8	0.24 (1)	8.25	E-B	-14 / 72	0.03 (4)
B-C	-311 / 0	-91.8	-91.8	0.24 (1)	8.25	A-E	9 / 246	0.08 (1)
F-A	-484 / 0	0.0	0.0	0.05 (1)	7.81	E-C	9 / 246	0.08 (1)
D-C	-484 / 0	0.0	0.0	0.05 (1)	7.81			
F-E	0 / 0	-18.5	-18.5	0.11 (4)	10.00			
E-D	0 / 0	-18.5	-18.5	0.11 (4)	10.00			

TOTAL WEIGHT = 37 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.30")
 CALCULATED VERT. DEFL.(LL) = 1/999 (0.00")
 ALLOWABLE DEFL.(TL) = L/360 (0.30")
 CALCULATED VERT. DEFL.(TL) = 1/999 (0.01")

CSI: TC=0.24/1.00 (A-B:1), BC=0.11/1.00 (E-F:4), WB=0.09/1.00 (C-E:1), SS=0.12/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR	SECTION
(PSI)	(PLI)
MAX MIN MAX MIN MAX MIN	
MT20	618 354 1667 788 1987 1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.42 (A) (INPUT = 0.90)
 JSI METAL= 0.12 (A) (INPUT = 1.00)

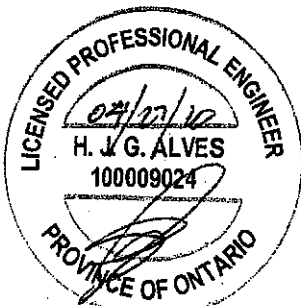

JOB NAME 408151	TRUSS NAME T34	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:20:00 2020 Page 1	
				ID:h2dflgC44wS_E2tzqPs_atzllRw-mBc3uRx8GmODTpiNn5xkQXdrLiC2aUv0ER7azNCXT	

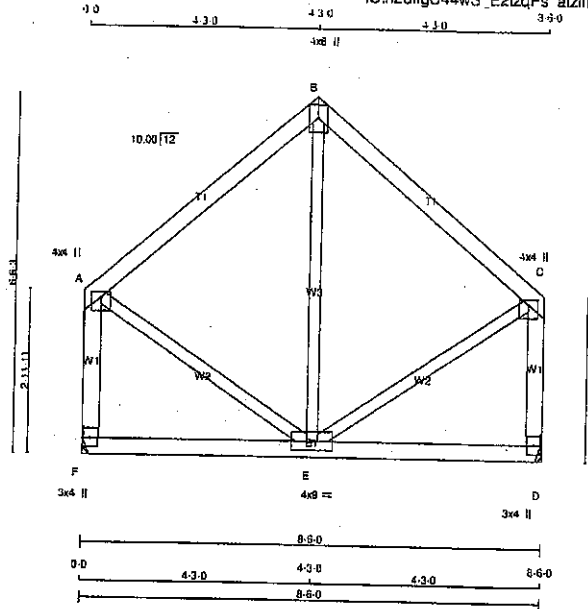

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
F - A	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
B	TTW+p	MT20	4.0	8.0	Edge	
C	TMVW+p	MT20	4.0	4.0	1.00	2.00
D	BMV1+p	MT20	3.0	4.0		
E	BMVW+L	MT20	4.0	9.0		
F	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
F	469	0	469	0	0
D	469	0	469	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D. MINIMUM BEARING LENGTH AT JOINT F = 1-8, JOINT D = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	331	217/0	0/0	0/0	0/0	114/0	0/0
D	331	217/0	0/0	0/0	0/0	114/0	0/0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (PLF)	MEMB.	FORCE (LBS)	MAX. (LBS)	MAX. (LBS)
FR-TO		FROM	TO	FR-TO			
A-B	-218/0	-91.8	-91.8 0.21 (1)	6.25	E-B	-111/32	0.07 (1)
B-C	-218/0	-91.8	-91.8 0.21 (1)	6.25	A-E	0/197	0.04 (1)
F-A	-438/0	0.0	0.0 0.07 (1)	7.81	E-C	0/197	0.04 (1)
D-C	-438/0	0.0	0.0 0.07 (1)	7.81			
F-E	0/0	-18.5	-18.5 0.09 (4)	10.00			
E-D	0/0	-18.5	-18.5 0.09 (4)	10.00			

TOTAL WEIGHT = 2 X 41 = 82 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.28")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.28")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.01")

CSI: TC=0.21/1.00 (A-B:1), BC=0.09/1.00 (E-F:4), WB=0.07/1.00 (B-E:1), SS=0.12/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX	MIN	MAX
MIN	MAX	MIN
MT20	618	354
	1667	788
	1987	1668

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.33 (A) (INPUT = 0.90)
JSI METAL = 0.09 (A) (INPUT = 1.00)




Structural component only
DWG# T-2007096

PLATES (table is in inches)						
T	TYPE	PLATES	W	LEN	Y	X
	TMVW-t	MT20	4.0	6.0		
	TMV+w	MT20	2.0	4.0		
	TMVW-t	MT20	4.0	6.0		
	BMVt+p	MT20	3.0	4.0		
	BMVWVW-t	MT20	4.0	9.0		

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

```
ISI GRIP= 0.59 ;C) (INPUT = 0.90 ;
ISI METAL= 0.21 ;C) (INPUT = 1.00 ;
```



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRAWG NO.
408151	T35	2	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Set Apr 25 11:20:01 2020 Page 2
ID:h2dlqC44wS E2tzcPs atzllRw-EO9R5nm13W44?Ovw8lKTxzhdf xTUd8gz f1zNCXS

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
F	BMV1+p	MT20	3.0	4.0		



Structural component only
DWG# T-2007097 72

[illegible]

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

Structural component only
DWG# T-2007107 *1/2*

CONTINUED ON PAGE 2

JOB NAME 408152 Tamarack Roof Truss, Burlington	TRUSS NAME T40	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---	-------------------	---------------	----------	-------------------------------	-------------	----------

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:32 2020 Page 2
ID: J7vF7aG0E03cRUj8X1SrkziWYK-0EAJ1sxZWS34IYeiZ2E6M6CTQSHDeTgR0niCQzNCOX

PLATES (table is in inches)

PLATE TYPE	PLATES	W	LEN	Y	X
B TMWW-t	MT20	5.0	8.0		
C TTWW+m	MT20	5.0	8.0	Edge	
D, E, G					
D TMWW-t	MT20	5.0	8.0		
F TS-t	MT20	5.0	6.0		
H TTWW+m	MT20	5.0	8.0	Edge	
I TMWW-t	MT20	5.0	8.0		
K BMV1+p	MT20	3.0	6.0		
L BMWW-t	MT20	5.0	6.0	2.50	2.50
M, O, P, R					
M BMWW-t	MT20	5.0	6.0		
N BS-t	MT20	5.0	6.0		
Q BS-t	MT20	5.0	6.0		
S BMWW-t	MT20	5.0	6.0	2.50	2.50
T BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING
TOTAL LOAD CASES: (4)


CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRAC LENGTH
FR-TO					FR-TO		
AQ-K	0.0	-18.5	-18.5	0.06 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)


JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-438	-438	---	FRONT	VERT	TOTAL	---	C1
E	17-7-0	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	29-3-8	-438	-438	---	FRONT	VERT	TOTAL	---	C1
N	29-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
L	29-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Q	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
S	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
U	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
V	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	18-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	17-7-0	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AL	19-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AM	21-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AN	25-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	27-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AP	31-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AQ	33-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

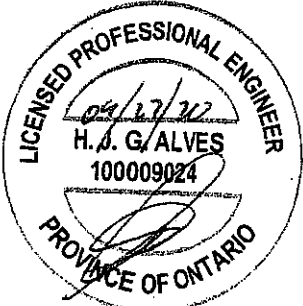

Structural component only
DWG# T-2007107 3/2

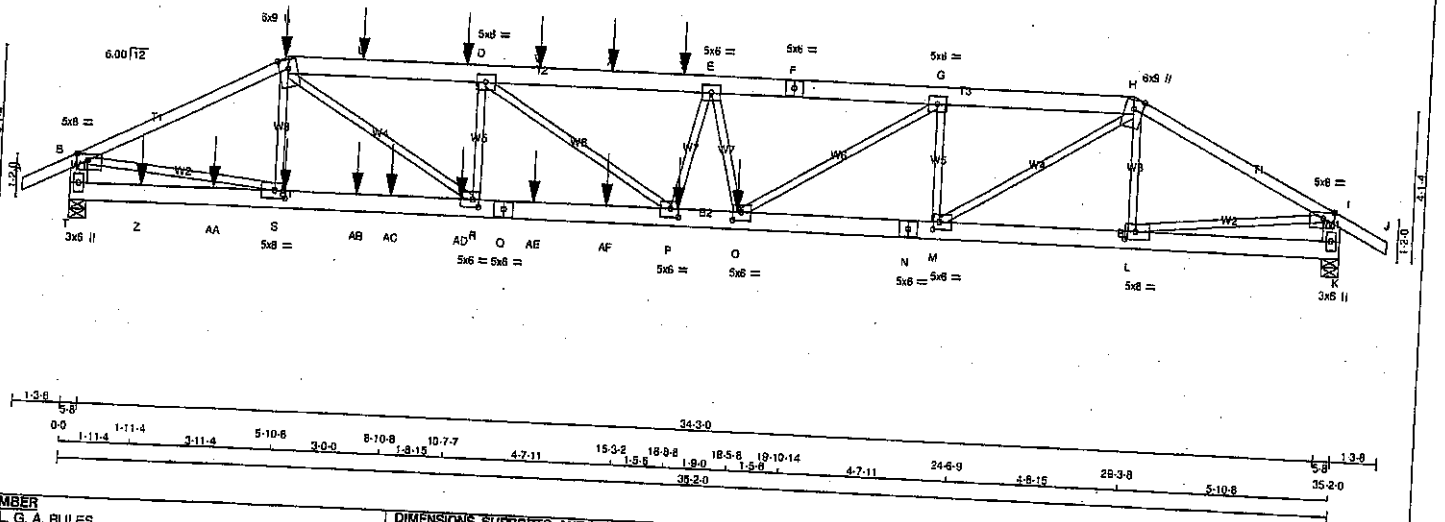

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - F	2x6	DRY	No.2	SPF		
F - H	2x4	DRY	No.2	SPF		
H - J	2x6	DRY	No.2	SPF		
J - L	2x4	DRY	No.2	SPF		
L - N	2x6	DRY	No.2	SPF		
N - K	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE(61.0)
H - J	12	TOP
C - F	12	SIDE(61.0)
F - H	12	TOP
T - B	12	TOP
K - I	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
T - Q	12	SIDE(183.1)
Q - N	12	SIDE(0.0)
N - K	12	TOP
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILED TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
VERT	HORZ	DOWN	HORZ
JT	4474	0	0
K	3775	0	0

UNFACTORED REACTIONS

1ST LOOSE	MAX/MIN	COMPONENT REACTIONS
T	SNOW	LIVE
JT	3182	2088/0
K	2685	1772/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, K

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.19 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS

MEMB.	MAX. FACTORED	FORCE	VERT.	LOADED	LC1	MAX	MAX.	UNBRAC	WEBS	MAX. FACTORED	FORCE	MAX
FR-TO	FROM	TO	LENGTH	FR-TO	MEMB.	MAX.	FORCE	MAX	CS1 (LC)	UNBRAC	MEMB.	MAX.

A-B	0/28	-91.8	-91.8	0.07 (1)	10.00	S-C	-384/25	0.05 (1)				
B-C	-7163/0	-91.8	-91.8	0.71 (1)	3.19	C-R	0/4687	0.58 (1)				
C-U	-10299/0	-91.8	-91.8	0.32 (1)	3.82	R-D	-2057/0	0.25 (1)				
U-V	-10299/0	-91.8	-91.8	0.32 (1)	3.82	C-G	0/3611	0.45 (1)				
V-D	-10299/0	-91.8	-91.8	0.32 (1)	3.82	M-G	-2637/0	0.32 (1)				
D-W	-12012/0	-91.8	-91.8	0.45 (1)	3.27	L-H	-616/0	0.08 (1)				
W-X	-12012/0	-91.8	-91.8	0.45 (1)	3.27	B-S	0/6479	0.80 (1)				
X-Y	-12012/0	-91.8	-91.8	0.45 (1)	3.27	D-P	0/5333	0.86 (1)				
Y-E	-12012/0	-91.8	-91.8	0.45 (1)	3.27	L-I	0/2066	0.26 (1)				
E-F	-12381/0	-91.8	-91.8	0.40 (1)	3.28	M-H	0/4950	0.61 (1)				
F-G	-12381/0	-91.8	-91.8	0.40 (1)	3.28	P-E	-1110/0	0.14 (1)				
G-H	-9386/0	-91.8	-91.8	0.25 (1)	3.94	E-O	0/383	0.05 (1)				
H-I	-5896/0	-91.8	-91.8	0.59 (1)	3.58							
I-J	0/28	-91.8	-91.8	0.07 (1)	10.00							
T-B	-4430/0	0.0	0.0	0.16 (1)	6.82							
K-I	-3716/0	0.0	0.0	0.13 (1)	7.31							

T-Z	0/0	-18.5	-18.5	0.08 (4)	10.00							
Z-AA	0/0	-18.5	-18.5	0.08 (4)	10.00							
AA-S	0/0	-18.5	-18.5	0.08 (4)	10.00							
S-AB	0/6432	-18.5	-18.5	0.69 (1)	10.00							
AB-AC	0/6432	-18.5	-18.5	0.69 (1)	10.00							
AC-AD	0/6432	-18.5	-18.5	0.69 (1)	10.00							
AD-R	0/6432	-18.5	-18.5	0.69 (1)	10.00							
R-Q	0/10298	-18.5	-18.5	0.76 (1)	10.00							
Q-AE	0/10298	-18.5	-18.5	0.76 (1)	10.00							
AE-AF	0/10298	-18.5	-18.5	0.76 (1)	10.00							
AF-P	0/10298	-18.5	-18.5	0.76 (1)	10.00							
P-O	0/12286	-18.5	-18.5	0.91 (1)	10.00							
O-N	0/9385	-18.5	-18.5	0.72 (1)	10.00							
N-M	0/9385	-18.5	-18.5	0.72 (1)	10.00							
M-L	0/5303	-18.5	-18.5	0.37 (1)	10.00							
L-K	0/0	-18.5	-18.5	0.04 (4)	10.00							

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-438	-438	---	BACK	VERT	TOTAL	---	C1
O	18-5-8	-2438	-2438	---	BACK	VERT	TOTAL	---	C1
P	16-9-12	-17	-17	---	BACK	VERT	TOTAL	---	C1
S	5-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
U	7-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	10-9-12	-82	-82	---	BACK	VERT	TOTAL	---	C1
W	12-9-12	-82	-82	---	BACK	VERT	TOTAL	---	C1

TOTAL WEIGHT = 2 X 170 = 341 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')

CALCULATED VERT. DEFL.(LL) = L/999 (0.31')

ALLOWABLE DEFL.(TL) = L/360 (1.17')

CALCULATED VERT. DEFL.(TL) = L/740 (0.57')

CS1: TC=0.71/1.00 (B-C-1), BC=0.91/1.00 (O-P-1), WS=0.80/1.00 (B-S-1), SSI=0.15/1.00 (R-S-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION


(PSI)	(PLI)	(PLI)
MIN	MAX	MIN
MT20	618	354
	1667	788
	1987	1856

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.89 (S) (INPUT = 0.90)

JSI METAL= 0.93 (N) (INPUT = 1.00)

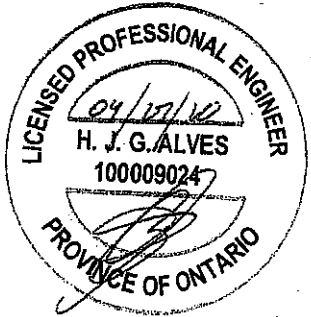

Structural component only
 DWG# T-2007108

JOB NAME 408152 Tamarack Roof Truss, Burlington	TRUSS NAME T40Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---	--------------------	---------------	----------	-------------------------------	-------------	----------

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:34 2020 Page 2
ID:7vF?aG0E03cRUj6X1jSkzIWKY-ydH2MjUB57mK3i1? 4iCnCV?E2GhUJzvKGpGJzNGOV

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	2.00	3.50
C	TTWW+m	MT20	6.0	9.0	Edge	
D, E, G						
D	TMVW-i	MT20	5.0	6.0		
F	TS-i	MT20	5.0	6.0		
H	TTWW+m	MT20	6.0	9.0	Edge	
I	TMVW-p	MT20	5.0	8.0	2.00	3.50
K	BMV1+p	MT20	3.0	6.0		
L	BMVW-i	MT20	5.0	8.0	2.50	3.50
M	BMVW-i	MT20	5.0	6.0	2.50	2.00
N	BS-i	MT20	5.0	6.0		
O	BMVW-i	MT20	5.0	6.0	2.75	2.75
P	BMVW-i	MT20	5.0	6.0	2.75	2.75
Q	BS-i	MT20	5.0	6.0		
R	BMVW-i	MT20	5.0	6.0	2.50	2.00
S	BMVW-i	MT20	5.0	8.0	2.50	3.50
T	BMV1+p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
X	14-9-12	-82	-82		BACK	VERT	TOTAL		C1
Y	16-9-12	-82	-82		BACK	VERT	TOTAL		C1
Z	1-11-4	-25	-26		BACK	VERT	TOTAL		C1
AA	3-11-4	-26	-26		BACK	VERT	TOTAL		C1
AB	7-11-4	-26	-26		BACK	VERT	TOTAL		C1
AC	8-10-8	-539	-539		BACK	VERT	TOTAL		C1
AD	10-9-12	-17	-17		BACK	VERT	TOTAL		C1
AE	12-9-12	-17	-17		BACK	VERT	TOTAL		C1
AF	14-9-12	-17	-17		BACK	VERT	TOTAL		C1


CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

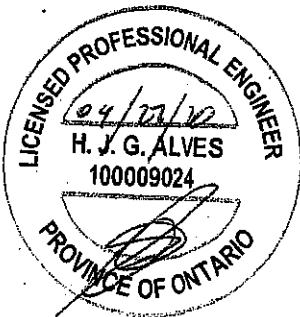

Structural component only
DWG# T-2007108

JOB NAME: 408152 TRUSS NAME: T41 QUANTITY: 2 PLY: 1 JOB DESC: GREEN PARK HOMES TRUSS DESC: Tamarack Roof Truss, Burlington DRWG NO. Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:35 2020 Page 1 ID:7vF7aG0E03cRUj6X1SkziWYK-QprGa2vprRqdxDHDYhbxk kd2eSiQx867_0NplzNCOU 20-9-7 27-3-8 31-1-9 31-0-8 35-2-0 35-5-8 1-3-8 Scale = 1/8" = 1'-0"

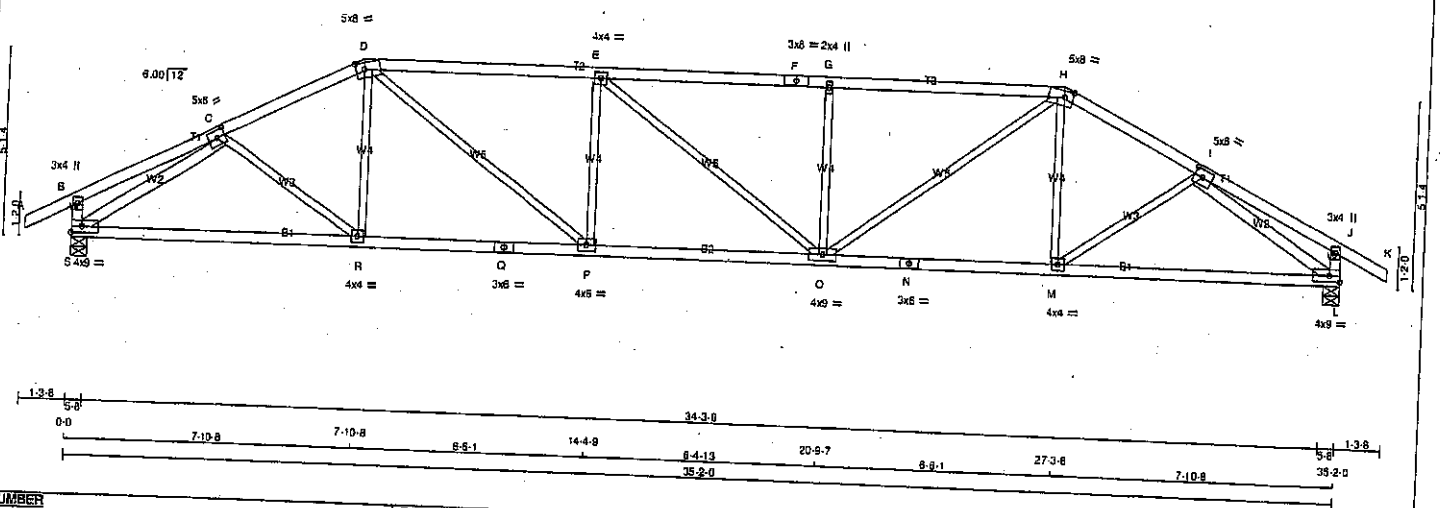

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - C	2x4	DRY	No.2
O - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY, SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
C	TMVW-i	MT20	5.0	6.0	2.50 2.75
D	TTWW-m	MT20	5.0	6.0	2.25 2.75
E	TMVW-i	MT20	4.0	4.0	
F	TS-i	MT20	3.0	4.0	
G	TMVW-w	MT20	2.0	4.0	
H	TTWW-m	MT20	5.0	6.0	2.25 2.75
I	TMVW-i	MT20	5.0	6.0	2.50 2.75
J	TMV+p	MT20	3.0	4.0	
L	BMVW-i	MT20	4.0	9.0	Edge
M	BMVW-i	MT20	4.0	4.0	
N	BS-i	MT20	3.0	6.0	
O	BMVW-i	MT20	4.0	9.0	
P	BMVW-i	MT20	4.0	6.0	
Q	BS-i	MT20	3.0	6.0	
R	BMVW-i	MT20	4.0	4.0	
S	BMVW-i	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECORD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
S	2063	0	2063	0	5-8	5-8
L	2063	0	2063	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX MIN. COMPONENT REACTIONS		DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE		
S	1457	969 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1457	969 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.94 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS						WEBS						
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX
FR-TO				CSI (LC)		FR-TO				FR-TO		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	C-R	0 / 93	0.03 (4)				
B-C	0 / 16	-91.8	-91.8	0.20 (1)	10.00	R-D	0 / 121	0.04 (4)				
C-D	-2799 / 0	-91.8	-91.8	0.32 (1)	3.88	D-P	0 / 1267	0.29 (1)				
D-E	-3508 / 0	-91.8	-91.8	0.95 (1)	2.94	P-E	-643 / 0	0.25 (1)				
E-F	-3507 / 0	-91.8	-91.8	0.93 (1)	2.94	E-O	-2 / 0	0.00 (1)				
F-G	-3507 / 0	-91.8	-91.8	0.93 (1)	2.94	O-G	-643 / 0	0.25 (1)				
G-H	-3507 / 0	-91.8	-91.8	0.94 (1)	2.55	C-H	0 / 1268	0.28 (1)				
H-I	-2799 / 0	-91.8	-91.8	0.32 (1)	3.88	M-I	0 / 93	0.03 (4)				
I-J	0 / 16	-91.8	-91.8	0.20 (1)	10.00	S-C	-2974 / 0	0.83 (1)				
J-K	0 / 28	-91.8	-91.8	0.12 (1)	10.00	I-L	-2974 / 0	0.83 (1)				
S-B	-270 / 0	0.0	0.0	0.03 (1)	7.81							
L-J	-270 / 0	0.0	0.0	0.03 (1)	7.81							
S-R	0 / 2417	-18.5	-18.5	0.53 (1)	10.00							
R-Q	0 / 2489	-18.5	-18.5	0.54 (1)	10.00							
Q-P	0 / 2489	-18.5	-18.5	0.54 (1)	10.00							
P-O	0 / 3509	-18.5	-18.5	0.64 (1)	10.00							
O-N	0 / 2489	-18.5	-18.5	0.54 (1)	10.00							
N-M	0 / 2489	-18.5	-18.5	0.54 (1)	10.00							
M-L	0 / 2417	-18.5	-18.5	0.53 (1)	10.00							

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.41")

CSI: TC=0.95/1.00 (D-E:1), BC=0.64/1.00 (O-P:1), WB=0.63/1.00 (I-L:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (L) (INPUT = 0.50)
JSI METAL = 0.77 (N) (INPUT = 1.00)

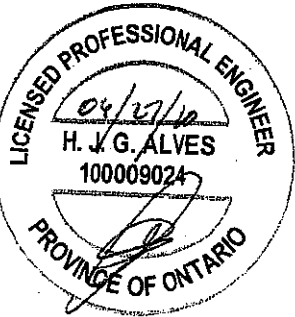


Structural component only
DWG# T-2007109

JOB NAME: 408152 TRUSS NAME: T42 QUANTITY: 2 PLY: 1 JOB DESC: GREEN PARK HOMES TRUSS DESC: Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:36 2020 Page 1

ID: j7vF?ag0E03cRUj6X1ISkZlWYK-u?PpnOvRckyUZNSP6PAHCHnN1r19RDGMelwLCzNCOT

Scale = 1:57.3

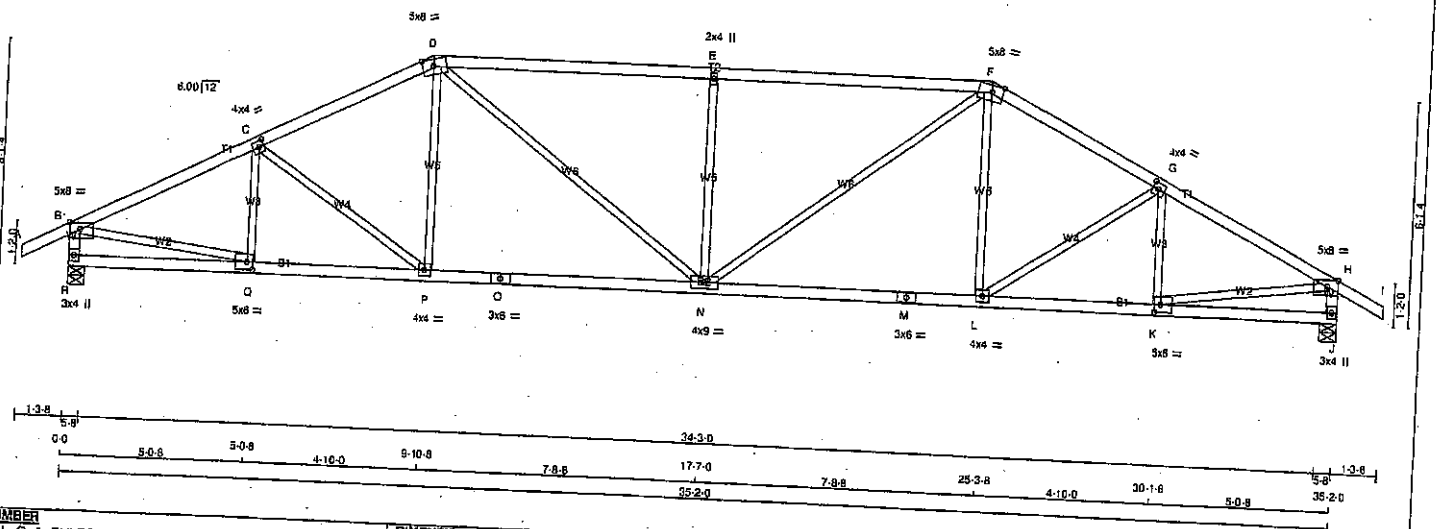

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
A - D	2x4	DRY No.2
D - F	2x4	DRY No.2
F - I	2x4	DRY No.2
I - H	2x4	DRY No.2
J - O	2x4	DRY No.2
O - M	2x4	DRY No.2
M - J	2x4	DRY No.2
ALL WEBS	2x3	DRY No.2

EXCEPT

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
A - TMVW-p	MT20	5.0	8.0	Edge	3.50
C - TMVW-t	MT20	4.0	4.0	2.00	1.75
D - TTWW-m	MT20	5.0	8.0	2.25	3.75
E - TMVW-w	MT20	2.0	4.0		
F - TTWW-m	MT20	5.0	8.0	2.25	3.75
G - TMVW-t	MT20	4.0	4.0	2.00	1.75
H - TMVW-p	MT20	5.0	8.0	Edge	3.50
J - BMVW-t	MT20	3.0	4.0		
K - BMVW-t	MT20	5.0	6.0	2.50	2.00
L - BS-t	MT20	4.0	4.0		
M - BS-t	MT20	3.0	6.0		
N - BMVW-t	MT20	4.0	4.0		
O - BS-t	MT20	3.0	6.0		
P - BMVW-t	MT20	4.0	4.0		
Q - BMVW-t	MT20	5.0	6.0	2.50	2.00
R - BMV-t	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT 2063	DOWN 2063	0	5-8
R HORZ 0	HORZ 0	0	5-8
J UPLIFT 0	UPLIFT 0	0	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT COMBINED	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
R	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
J	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 278 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS										WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC4)	MAX. FACTORED VERT. LOAD (LC5)	MAX. FACTORED VERT. LOAD (LC6)	MAX. FACTORED VERT. LOAD (LC7)	MAX. FACTORED VERT. LOAD (LC8)	
R-TO		FROM TO				FR-TO							
B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	C-C	-353 / 0				0.08 (1)		
C	-2834 / 0	-91.8	-91.8	0.39 (1)	3.81	C-P	-210 / 0				0.13 (1)		
D	-2687 / 0	-91.8	-91.8	0.37 (1)	3.91	P-D	0 / 246				0.06 (4)		
E	-3060 / 0	-91.8	-91.8	0.97 (1)	2.78	D-N	0 / 844				0.19 (1)		
F	-3060 / 0	-91.8	-91.8	0.97 (1)	2.78	N-E	-872 / 0				0.51 (1)		
G	-2867 / 0	-91.8	-91.8	0.37 (1)	3.91	N-F	0 / 844				0.19 (1)		
H	-2834 / 0	-91.8	-91.8	0.39 (1)	3.81	L-F	0 / 246				0.08 (4)		
I	0 / 28	-91.8	-91.8	0.12 (1)	10.00	L-G	-210 / 0				0.13 (1)		
B	-2018 / 0	0.0	0.0	0.20 (1)	5.94	K-G	-353 / 0				0.08 (1)		
H	-2018 / 0	0.0	0.0	0.20 (1)	5.94	B-Q	0 / 2591				0.58 (1)		
						K-H	0 / 2591				0.58 (1)		
Q	0 / 0	-18.5	-18.5	0.10 (4)	10.00								
P	0 / 2555	-18.5	-18.5	0.51 (1)	10.00								
N	0 / 2386	-18.5	-18.5	0.49 (1)	10.00								
M	0 / 2386	-18.5	-18.5	0.49 (1)	10.00								
L	0 / 2386	-18.5	-18.5	0.49 (1)	10.00								
K	0 / 2386	-18.5	-18.5	0.49 (1)	10.00								
J	0 / 2555	-18.5	-18.5	0.51 (1)	10.00								
I	0 / 0	-18.5	-18.5	0.10 (4)	10.00								

TOTAL WEIGHT = 2 X 139 = 277 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")

CALCULATED VERT. DEFL. (LL) = L/999 (0.17")

ALLOWABLE DEFL. (TL) = L/360 (1.17")

CALCULATED VERT. DEFL. (TL) = L/999 (0.34")

CSI: TC=0.97/1.00 (D-E-1), BC=0.51/1.00 (K-L-1), WB=0.58/1.00 (H-K-1), SS=0.34/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 618 354 1687 788 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (D) (INPUT = 0.80)


JSI METAL= 0.75 (D) (INPUT = 1.00)

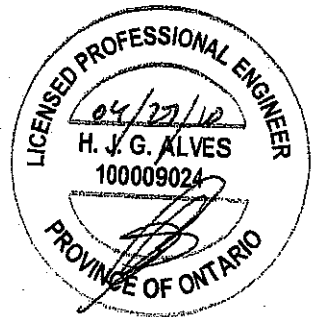

Structural component only
DWG# T-2007110

JOB NAME: 408152 TRUSS NAME: T43 QUANTITY: 2 PLY: 1 JOB DESC: GREEN PARK HOMES TRUSS DESC: Tamarack Roof Truss, Burlington

Version B.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:29:37 2020 Page 1
 ID: 7Vf?ag0E03cRUj6X1jSrkzIWK-MCzB_kw3N24L.BWQc9dPpPq2FRBXutKpbIVTszNCOS
 Scale = 1:57.3

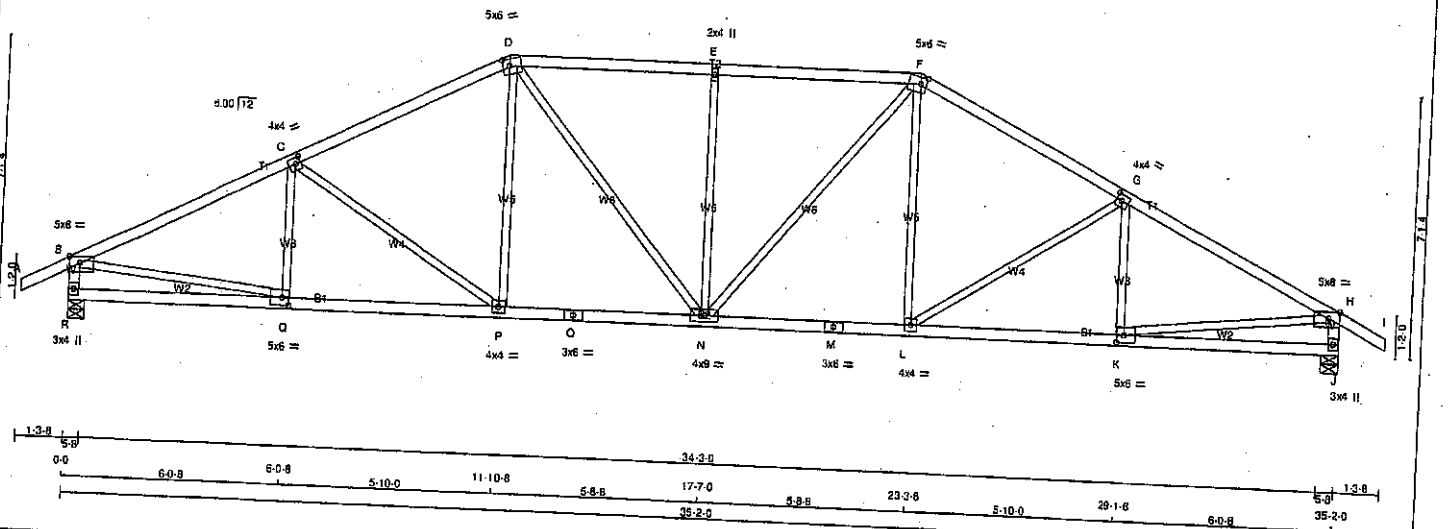

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
A - D	2x4	DRY No.2
D - F	2x4	DRY No.2
F - J	2x4	DRY No.2
J - H	2x4	DRY No.2
R - O	2x4	DRY No.2
O - M	2x4	DRY No.2
M - J	2x4	DRY No.2

ALL WEBS 2x3 DRY No.2
 EXCEPT
 DRY, SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TMVW-t	MT20	4.0	4.0	2.00	1.75
D	TTVW-m	MT20	5.0	8.0	2.25	2.00
E	TMVW-w	MT20	2.0	4.0		
F	TTVW-m	MT20	5.0	6.0	2.25	2.00
G	TMVW-t	MT20	4.0	4.0	2.00	1.75
H	TMVW-p	MT20	5.0	8.0	Edge	3.50
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-t	MT20	5.0	6.0	2.50	2.25
L	BMVW-t	MT20	4.0	4.0		
M	BS-t	MT20	3.0	6.0		
N	BMVW-t	MT20	4.0	4.0		
O	BS-t	MT20	3.0	6.0		
P	BMVW-t	MT20	4.0	4.0		
Q	BMVW-t	MT20	5.0	8.0	2.50	2.25
R	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
R	2083	0	2083	0	5-8	5-8
J	2083	0	2083	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
R	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
J	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	LENGTH FR-TO
FR-TO				FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	Q-C	-255 / 12	0.07 (1)	10.00
B-C	-2889 / 0	-91.8	-91.8 0.58 (1)	C-P	-435 / 0	0.42 (1)	3.58
C-D	-2539 / 0	-91.8	-91.8 0.52 (1)	P-D	0 / 350	0.08 (1)	3.83
D-E	-2559 / 0	-91.8	-91.8 0.48 (1)	D-N	0 / 482	0.11 (1)	3.65
E-F	-2559 / 0	-91.8	-91.8 0.48 (1)	N-E	-841 / 0	0.58 (1)	3.65
F-G	-2539 / 0	-91.8	-91.8 0.52 (1)	E-F	0 / 360	0.08 (1)	3.83
G-H	-2889 / 0	-91.8	-91.8 0.58 (1)	H-F	0 / 482	0.11 (1)	3.65
H-I	0 / 28	-91.8	-91.8 0.12 (1)	I-F	0 / 360	0.08 (1)	3.83
I-R	-2014 / 0	0.0	0.0 0.20 (1)	L-G	-435 / 0	0.42 (1)	10.00
J-H	-2014 / 0	0.0	0.0 0.20 (1)	K-G	-255 / 12	0.07 (1)	3.58
				G-Q	0 / 2635	0.59 (1)	3.65
				K-H	0 / 2635	0.59 (1)	3.65
R-Q	0 / 0	-18.5	-18.5 0.15 (4)				
Q-P	0 / 2809	-18.5	-18.5 0.49 (1)				
P-O	0 / 2249	-18.5	-18.5 0.43 (1)				
O-N	0 / 2249	-18.5	-18.5 0.43 (1)				
N-M	0 / 2249	-18.5	-18.5 0.43 (1)				
M-L	0 / 2249	-18.5	-18.5 0.43 (1)				
L-K	0 / 2809	-18.5	-18.5 0.49 (1)				
K-J	0 / 0	-18.5	-18.5 0.15 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 BOT CH. LL = 6.0 PSF
 DL = 0.0 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
 CALCULATED VERT. DEFL. (LL) = L/999 (0.15")
 ALLOWABLE DEFL. (TL) = L/360 (1.17")
 CALCULATED VERT. DEFL. (TL) = L/989 (0.28")

CSI: TC=0.59/1.00 (G-H-I), BC=0.49/1.00 (K-L-I), WB=0.59/1.00 (B-C-I), SS=0.25/1.00 (D-E-I)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788 1997 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (O) (INPUT = 0.90)
 JSI METAL = 0.69 (M) (INPUT = 1.00)

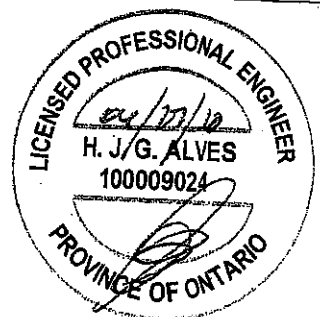


Structural component only
 DWG# T-2007111

The drawing shows a roof truss system with a total width of 35.2.0. The roof slope is 1:3.8. The truss consists of a main roof truss and a lower truss. The main roof truss has a peak height of 8.1.4. The lower truss has a height of 1.3.8. The main roof truss members are labeled with their cross-sections: 4x8 for the top chord, 3x8 for the bottom chord, 4x4 for the verticals, and 4x6 for the diagonals. The lower truss members are labeled with their cross-sections: 3x6 for the top chord, 3x8 for the bottom chord, 4x4 for the verticals, and 4x6 for the diagonals. The truss is supported by a central pier and two side piers. The dimensions are given in feet and inches.

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.


S-R	0/0	-18.5	-18.5	0.20 (4)	10.00
R-Q	0/2630	-18.5	-18.5	0.52 (1)	10.00
Q-P	0/2630	-18.5	-18.5	0.52 (1)	10.00
P-O	0/2193	-18.5	-18.5	0.45 (1)	10.00
O-N	0/2630	-18.5	-18.5	0.52 (1)	10.00
N-M	0/2630	-18.5	-18.5	0.52 (1)	10.00
M-L	0/0	-18.5	-18.5	0.20 (4)	10.00

SI GRIP= 0.88 (N) (INPUT = 0.90)
SI METAL= 0.79 (N) (INPUT = 1.00)



JOB NAME: 408152 TRUSS NAME: T45 QUANTITY: 2 PLY: 1 JOB DESC: GREEN PARK HOMES TRUSS DESC: Tamarack Roof Truss, Burlington DRWG NO.

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:39 2020 Page 1
ID:17vF?aG0E03cRUj6X1jSkzWYK-Ja5xPQyKvIK3Qaa.nXgtvqRdFwMjnc_ayWzNCOQ

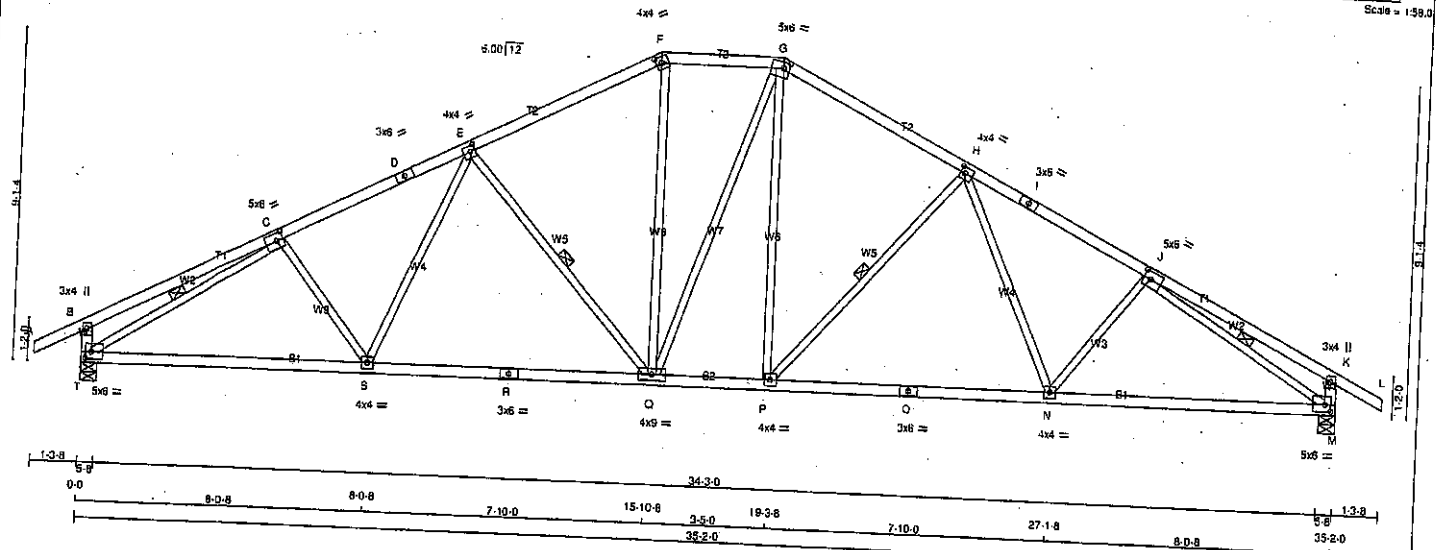

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
A - D	2x4	DRY
D - F	2x4	DRY
F - G	2x4	DRY
G - I	2x4	DRY
I - L	2x4	DRY
L - M	2x4	DRY
M - K	2x4	DRY
K - R	2x4	DRY
R - O	2x4	DRY
O - M	2x4	DRY
ALL WEBS	2x3	DRY
EXCEPT		No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMWW-t	MT20	5.0	8.0	2.50	2.25
D TS-t	MT20	3.0	5.0		
E TMWW-t	MT20	4.0	4.0	2.00	1.50
F TTW-h	MT20	4.0	4.0	2.00	1.75
G TTWW-m	MT20	5.0	6.0	2.00	2.00
H TMWW-t	MT20	4.0	4.0	2.00	1.50
I TS-t	MT20	3.0	6.0		
J TMWW-t	MT20	5.0	8.0	2.50	2.25
K TMV+p	MT20	3.0	4.0		
M BMVW1-t	MT20	5.0	6.0	2.25	2.00
N, P, S					
N BMVW-t	MT20	4.0	4.0		
O BS-t	MT20	3.0	6.0		
Q BMVW-t	MT20	4.0	9.0		
R BS-t	MT20	3.0	6.0		
T BMVW1-t	MT20	5.0	6.0	2.25	2.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	UP		
T	2063	0	2063	0	5-6	5-6
M	2063	0	2063	0	5-6	5-6

UNFACTORED REACTIONS

JT	1ST CASE		MAX/MIN. COMPONENT REACTIONS		DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE		
T	1457	969 / 0	0 / 0	0 / 0	498 / 0	0 / 0
M	1457	969 / 0	0 / 0	0 / 0	498 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.86 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.


ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, H-P, C-T, J-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS	
	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO						
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	0.04 (1)
B-C	0 / 19	-91.8	-91.8	0.32 (1)	10.00	0.06 (1)
C-D	-2759 / 0	-91.8	-91.8	0.40 (1)	10.00	0.31 (1)
D-E	-2759 / 0	-91.8	-91.8	0.40 (1)	10.00	0.31 (1)
E-F	-2187 / 0	-91.8	-91.8	0.35 (1)	4.30	0.14 (1)
F-G	-1925 / 0	-91.8	-91.8	0.18 (1)	4.71	0.00 (1)
G-H	-2185 / 0	-91.8	-91.8	0.36 (1)	4.30	0.14 (1)
H-I	-2760 / 0	-91.8	-91.8	0.40 (1)	10.00	0.31 (1)
I-J	-2760 / 0	-91.8	-91.8	0.40 (1)	10.00	0.31 (1)
J-K	0 / 19	-91.8	-91.8	0.32 (1)	10.00	0.04 (1)
K-L	0 / 28	-91.8	-91.8	0.12 (1)	10.00	0.06 (1)
L-M	-326 / 0	0.0	0.0	0.03 (1)	7.81	0.85 (1)
M-K	-326 / 0	0.0	0.0	0.03 (1)	7.81	0.85 (1)
T-S	0 / 2536	-18.5	-18.5	0.55 (1)	10.00	
S-R	0 / 2362	-18.5	-18.5	0.53 (1)	10.00	
R-Q	0 / 2362	-18.5	-18.5	0.53 (1)	10.00	
Q-P	0 / 1924	-18.5	-18.5	0.40 (1)	10.00	
P-O	0 / 2362	-18.5	-18.5	0.53 (1)	10.00	
O-N	0 / 2362	-18.5	-18.5	0.53 (1)	10.00	
N-M	0 / 2537	-18.5	-18.5	0.55 (1)	10.00	

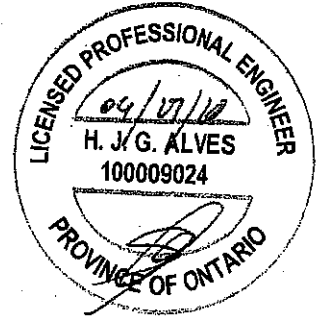

Structural component only
DWG# T-2007113

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.32")

CSI: TC=0.40/1.00 (H-J-1), BC=0.55/1.00 (M-N-1), WS=0.85/1.00 (J-M-1), SS=0.20/1.00 (B-C-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (M) (INPUT = 0.90)
JSI METAL = 0.83 (C) (INPUT = 1.00)

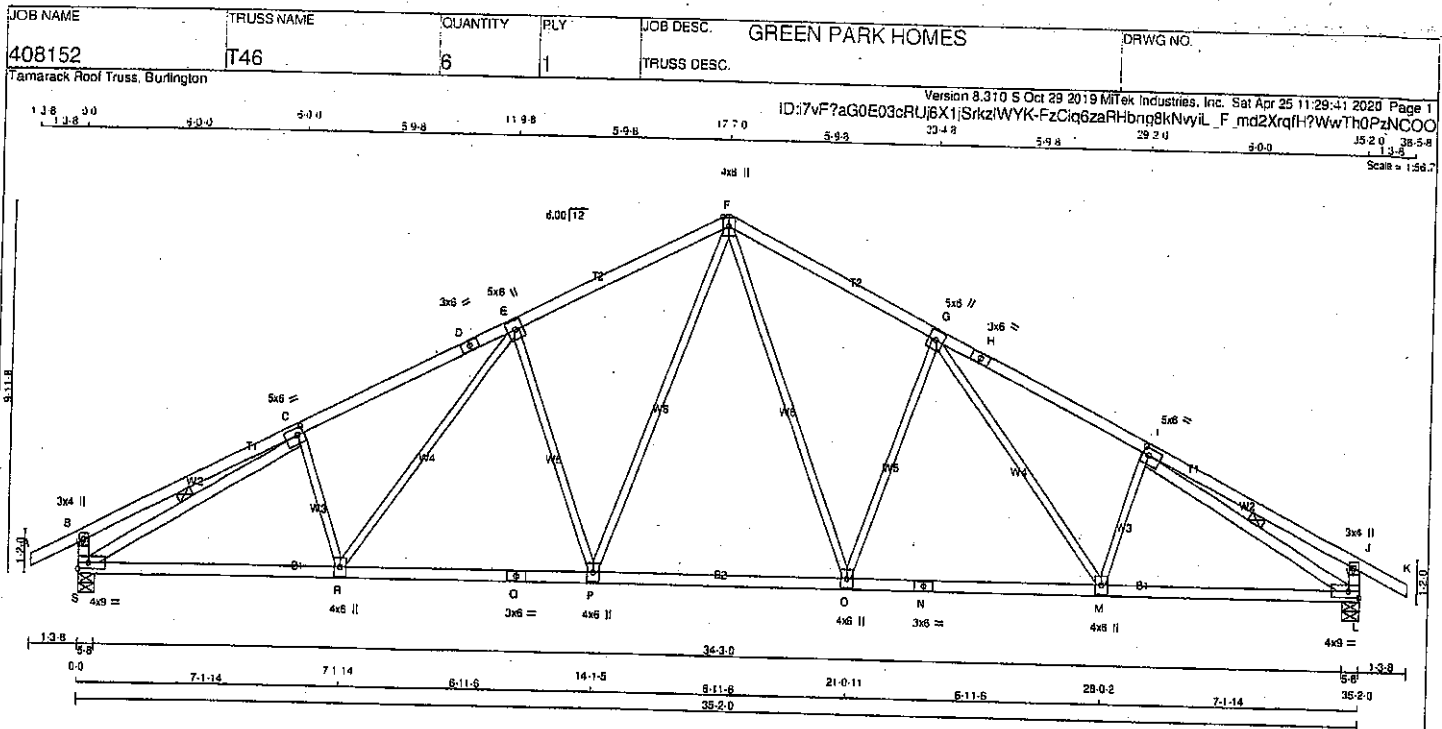

TOTAL WEIGHT = 6 X 152 = 910 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
A - D	2x4	DRY No.2
D - F	2x4	DRY No.2
F - H	2x4	DRY No.2
H - K	2x4	DRY No.2
S - B	2x4	DRY No.2
L - J	2x4	DRY No.2
S - Q	2x4	DRY No.2
Q - N	2x4	DRY No.2
N - L	2x4	DRY No.2
ALL WEBS EXCEPT	2x3	DRY No.2
S - C	2x4	DRY No.2
I - L	2x4	DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-i	MT20	5.0	6.0	2.25	2.00
D	TS-i	MT20	3.0	6.0		
E	TMWW+i	MT20	5.0	6.0		
F	TMWW+p	MT20	4.0	6.0	Edge	
G	TMWW-i	MT20	5.0	6.0		
H	TS-i	MT20	3.0	6.0		
I	TMWW-i	MT20	5.0	6.0	2.25	2.00
J	TMV+p	MT20	3.0	4.0		
L	BMWW-i	MT20	4.0	9.0	Edge	
M, O, P, R						
N	BMWW-i	MT20	4.0	6.0		
Q	BS-i	MT20	3.0	6.0		
S	BMWW-i	MT20	4.0	9.0	Edge	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
S	2083	0	2083	0	5-8	5-8
L	2083	0	2083	0	5-8	5-8

UNFACTORED REACTIONS

JT	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
S	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0
L	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, H-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS			WEBS		
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. FACTORED CSI (LC)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	MAX. FACTORED CSI (LC)
FR-TO						
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	F-O	0 / 866
B-C	0 / 22	-91.8	-91.8 0.40 (1)	10.00	O-G	-726 / 0
C-D	-2808 / 0	-91.8	-91.8 0.49 (1)	3.75	G-M	0 / 391
D-E	-2808 / 0	-91.8	-91.8 0.49 (1)	3.75	M-I	-192 / 18
E-F	-2322 / 0	-91.8	-91.8 0.46 (1)	4.07	P-F	0 / 866
F-G	-2322 / 0	-91.8	-91.8 0.46 (1)	4.07	E-P	-726 / 0
G-H	-2808 / 0	-91.8	-91.8 0.49 (1)	3.75	R-E	0 / 391
H-I	-2808 / 0	-91.8	-91.8 0.49 (1)	3.75	C-R	-192 / 18
I-J	0 / 22	-91.8	-91.8 0.40 (1)	10.00	S-C	-3084 / 0
J-K	0 / 28	-91.8	-91.8 0.12 (1)	10.00	I-L	-3064 / 0
S-B	-344 / 0	0.0	0.0 0.03 (1)	7.81		
L-J	-344 / 0	0.0	0.0 0.03 (1)	7.81		
S-R	0 / 2574	-18.5	-18.5 0.53 (1)	10.00		
R-O	0 / 2291	-18.5	-18.5 0.47 (1)	10.00		
Q-P	0 / 2291	-18.5	-18.5 0.47 (1)	10.00		
P-O	0 / 1762	-18.5	-18.5 0.38 (1)	10.00		
O-N	0 / 2291	-18.5	-18.5 0.47 (1)	10.00		
N-M	0 / 2291	-18.5	-18.5 0.47 (1)	10.00		
M-L	0 / 2574	-18.5	-18.5 0.53 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.26")

CSI: TC=0.49/1.00 (C-E:1), BC=0.53/1.00 (L-M:1), WB=0.72/1.00 (E-P:1), SS=0.22/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(FSL)	(PLI)	(PLJ)	
	MAX	MIN	MAX MIN
MT20	618	354	1667 788 1967 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.87 (C) (INPUT = 0.90)

JSI METAL = 0.77 (I) (INPUT = 1.00)

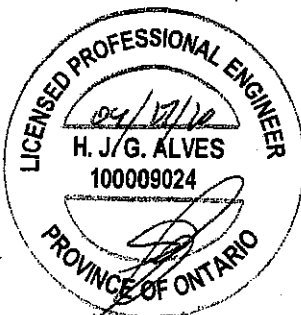

Structural component only
DWG# T-2007114


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	T47	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:42 2020 Page 1

ID:7vF?ag0E03cRUj6X1jSkzIWK-9m42R_CCaJeHjZTfDaWTxzGSyYZD8kZDEYrZNGON

Scale = 1/2" = 1'-0"

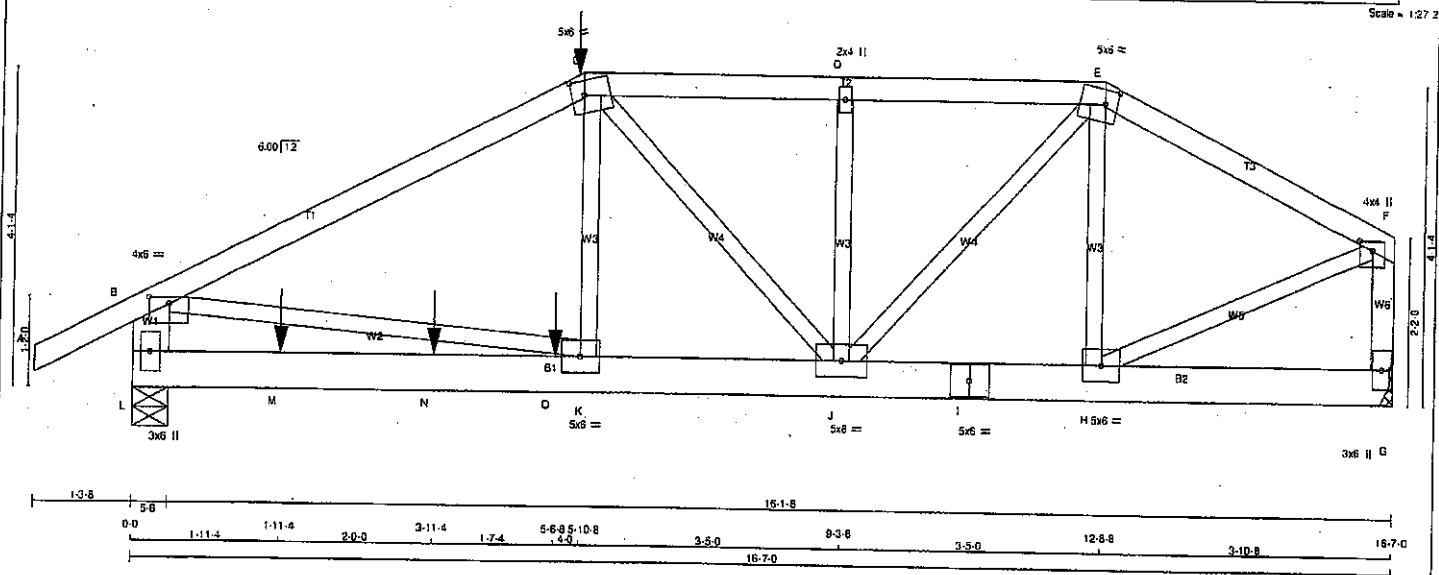

TOTAL WEIGHT = 2 X 78 = 156 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
L - B	2x6	DRY	No.2
G - F	2x4	DRY	No.2
L - I	2x6	DRY	No.2
I - G	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE(01.0)
C - E	12	SIDE(01.0)
E - F	12	TOP
G - F	12	TOP
L - B	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
L - I	12	SIDE(0.0)
I - G	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
L	2005	0	2005	0
G	1397	0	1397	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 2-0.

UNFACTORED REACTIONS

1ST LOSE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED
L	1412
G	985

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.18 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO			FR-TO	
A-B	0/23	-91.3	K-C	0/943
B-C	-2843/0	-91.3	C-J	-846/0
C-D	-1951/0	-91.3	J-D	-371/0
D-E	-1951/0	-91.3	E-J	0/1047
E-F	-1405/0	-91.3	H-E	-446/0
L-B	-1885/0	0.0	B-K	0/2382
G-F	-1369/0	0.0	H-F	0/1375
L-M	0/0	-18.5		
M-N	0/0	-18.5		
N-O	0/0	-18.5		
O-K	0/0	-18.5		
K-J	0/2389	-18.5		
J-I	0/1243	-18.5		
I-H	0/1243	-18.5		
H-G	0/0	-18.5		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-320	-320	---	FRONT	VERT	TOTAL	C1
M	1-11-4	-25	-25	---	FRONT	VERT	TOTAL	C1
N	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	C1
O	5-6-8	-1076	-1076	---	FRONT	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	DL	= 25.6	PSF
BOT CH.	DL	= 6.0	PSF
	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.55")
CALCULATED VERT. DEFL.(TL) = L/999 (0.06")

CSI: TC=0.371/0.0 (B-C:1), BC=0.24/1.00 (J-K:1), WB=0.29/1.00 (B-K:1), SSI=0.371/0.0 (K-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 . 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.80 (B) (INPUT = 0.80)
JSI METAL= 0.32 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007115


CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	T47	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 11:29:42 2020 Page 2
ID:7vF?aG0E03cRUI6X1jSrkzWYK-9m42R CCaieHIJZTfDaWTXzGSyYZDD8kZDEYzNCON

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	6.0	1.00	3.00
C	TTWW-m	MT20	5.0	6.0	2.25	2.00
D	TMW+w	MT20	2.0	4.0		
E	TTWW-m	MT20	5.0	6.0	2.25	2.00
F	TMVW+p	MT20	4.0	4.0	1.50	2.00
G	BMV1+p	MT20	3.0	6.0		
H	BMWW-t	MT20	5.0	6.0		
I	BS-1	MT20	5.0	6.0		
J	BMWWW-t	MT20	5.0	8.0		
K	BMWW-t	MT20	5.0	6.0		
L	BMV1+p	MT20	3.0	6.0		

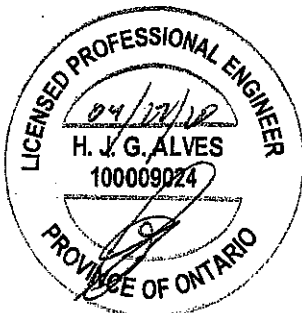


Structural component only
DWG# T-2007115 *W*

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	T48	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:43 2020 Page 1
ID:7vF?aG0E03cRUj6X1jSkzWYK-BMKSFn?qzurVvRu0Nkp3g47HsGXdlizDyo5IzNCOM

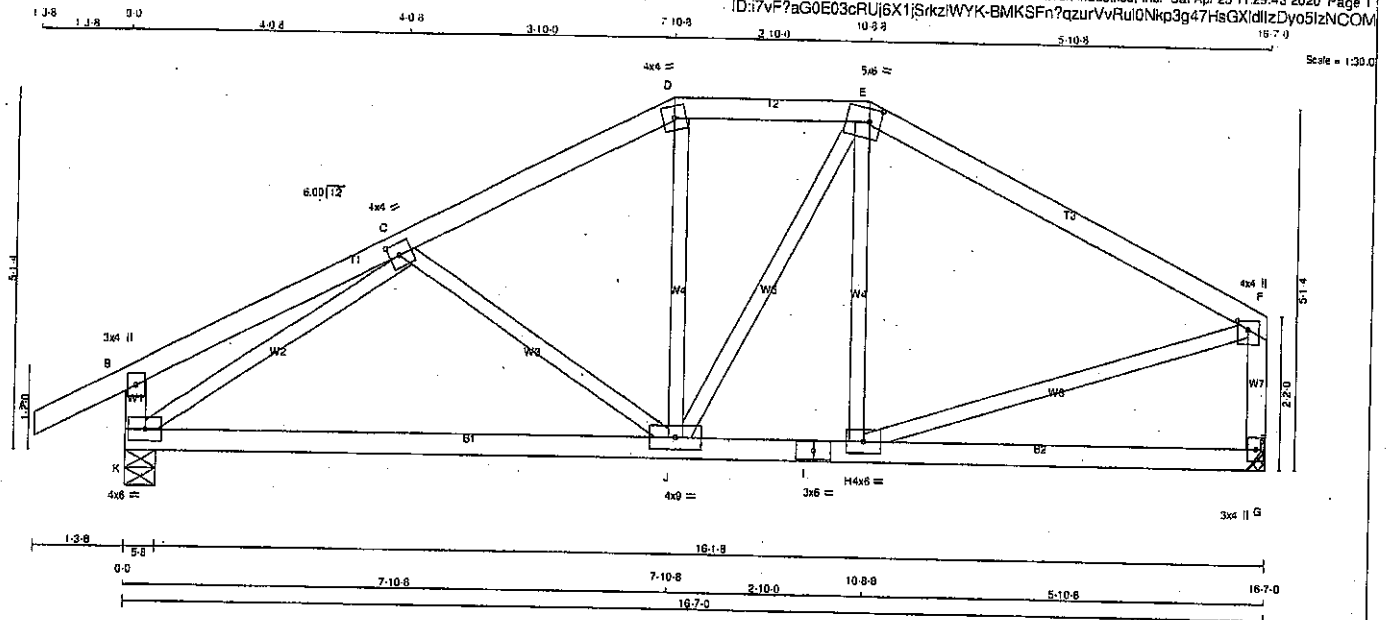

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4 DRY	No.2		
E - F	2x4 DRY	No.2		
G - H	2x4 DRY	No.2		
I - J	2x4 DRY	No.2		
K - L	2x4 DRY	No.2		

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMWW-t	MT20	4.0	4.0	2.00	1.75
D TTW-m	MT20	4.0	4.0		
E TTWW-m	MT20	5.0	6.0	2.25	2.00
F TMVW+p	MT20	4.0	4.0	1.50	2.00
G BMV1+p	MT20	3.0	4.0		
H BMWW-t	MT20	4.0	6.0		
I BS-t	MT20	3.0	6.0		
J BMWWW-t	MT20	4.0	9.0		
K BMVW1-t	MT20	4.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED		MAXIMUM FACTORED		INPUT		REQD	
	GROSS REACTION	GROSS REACTION	DOWN	HORIZ	BRG	BRG	IN-SX	IN-SX
K	1039	0	1039	0	5-8	5-8		
G	914	0	914	0	MECHANICAL			

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	MAX./MIN. COMPONENT REACTIONS						
	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	732	484 / 0	0 / 0	0 / 0	0 / 0	238 / 0	0 / 0
G	646	424 / 0	0 / 0	0 / 0	0 / 0	222 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.12 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PL)	MAX. FACTORED CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)	
FR-TO				FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	C-J	-232 / 0	0.10 (1)	
B-C	0 / 18	-91.8	-91.8 0.22 (1)	J-D	0 / 134	0.03 (4)	
C-D	-916 / 0	-91.8	-91.8 0.18 (1)	J-E	0 / 152	0.03 (1)	
D-E	-806 / 0	-91.8	-91.8 0.10 (1)	H-E	-163 / 0	0.05 (1)	
E-F	-821 / 0	-91.8	-91.8 0.42 (1)	K-C	-1221 / 0	0.47 (1)	
K-B	-265 / 0	0.0	0.0 0.03 (1)	H-F	0 / 769	0.17 (1)	
G-F	-866 / 0	0.0	0.0 0.10 (1)				
K-J	0 / 993	-18.5	-18.5 0.32 (4)				
J-I	0 / 731	-18.5	-18.5 0.31 (4)				
I-H	0 / 731	-18.5	-18.5 0.31 (4)				
H-G	0 / 0	-18.5	-18.5 0.15 (4)				

TOTAL WEIGHT = 88 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.55")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CS1: TO=0.42/1.00 (E-F:1), BC=0.32/1.00 (J-K:4), WB=0.47/1.00 (C-K:1), SS1=0.19/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN
MT20 618 354 1987 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (C) (INPUT = 0.90)
JSI METAL = 0.41 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007116

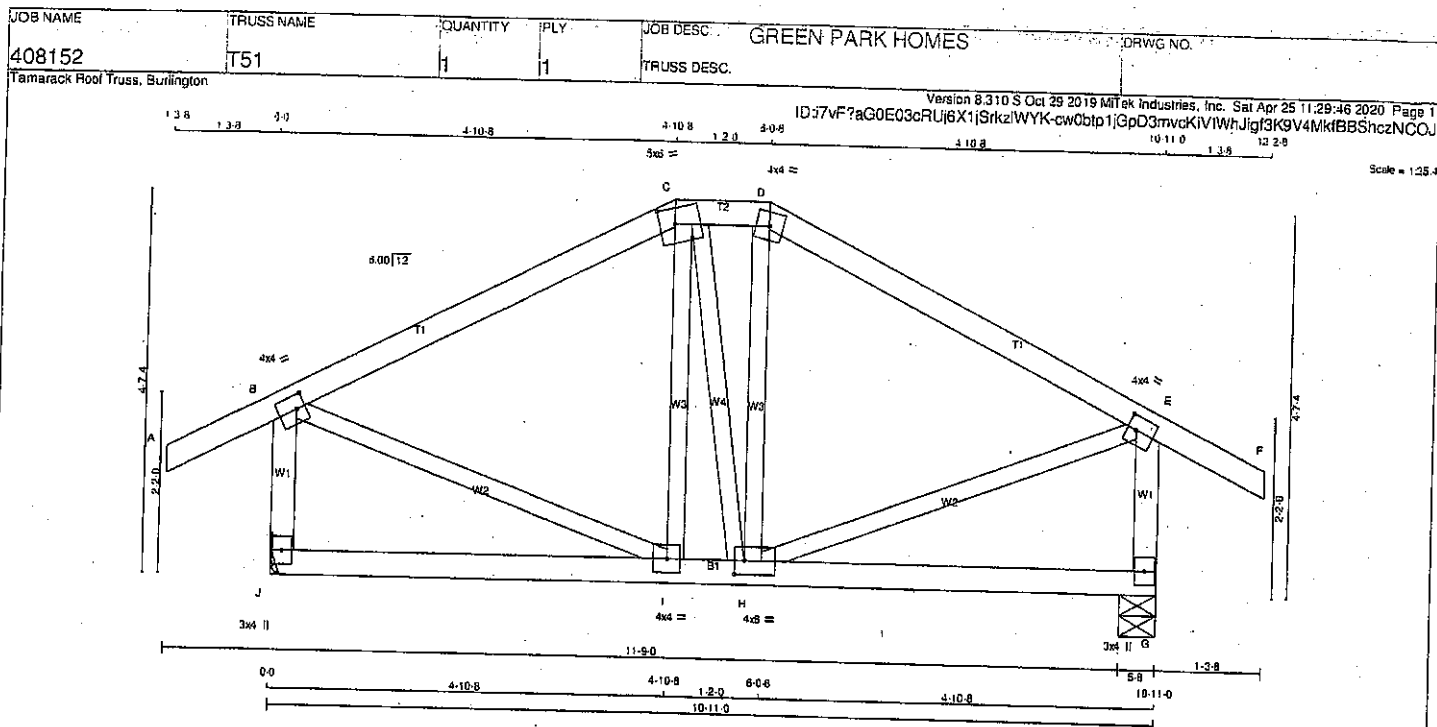

TOTAL WEIGHT = 52 k (M/P)

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
G - H	2x4	DRY	No.2	SPF
H - I	2x4	DRY	No.2	SPF
I - J	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	4.0	2.00	1.25
C	TTWV-m	MT20	5.0	6.0	2.25	2.25
D	TTW-m	MT20	4.0	4.0		
E	TMVW-1	MT20	4.0	4.0	2.00	1.25
G	BMV1+p	MT20	3.0	4.0		
H	BMVWV-1	MT20	4.0	6.0	2.00	1.50
I	BMVWV-1	MT20	4.0	4.0		
J	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	IN-SX
JT	VERT	HORZ	DOWN
J	726	0	0
G	726	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 1-8.

UNFACTORED REACTIONS

1ST CASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED
	SNOW
	LIVE
	PERM. LIVE
	WIND
	DEAD
	SOIL
J	511
G	511

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD
	(LBS)	(PLF)	(LC)		(LBS)	(PLF)	(LC)
FR-TO				FR-TO			
A-B	0/28	-91.8	-91.8	I-C	-78/18	0.02	(1)
B-C	-435/0	-91.8	-91.8	C-H	-4/0	0.00	(1)
C-D	-388/0	-91.8	-91.8	H-D	-82/19	0.03	(1)
D-E	-434/0	-91.8	-91.8	B-I	0/415	0.09	(1)
E-F	0/28	-91.8	-91.8	H-E	0/414	0.09	(1)
F-G	-888/0	0.0	0.0				
G-H	-888/0	0.0	0.0				
J-I	0/0	-18.5	-18.5				
I-H	0/367	-18.5	-18.5				
H-G	0/0	-18.5	-18.5				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.36")

CALCULATED VERT. DEFL.(LL) = L/999 (0.01")

ALLOWABLE DEFL.(TL) = L/360 (0.36")

CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TO=0.28/1.00 (B-C:1), BC=0.14/1.00 (H-I:4), WB=0.09/1.00 (B-I:1), SS=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 518 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.66 (B) (INPUT = 0.90)

JSI METAL= 0.22 (B) (INPUT = 1.00)

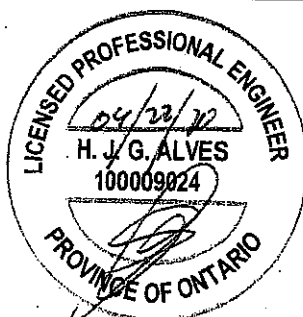

Structural component only
DWG# T-2007119

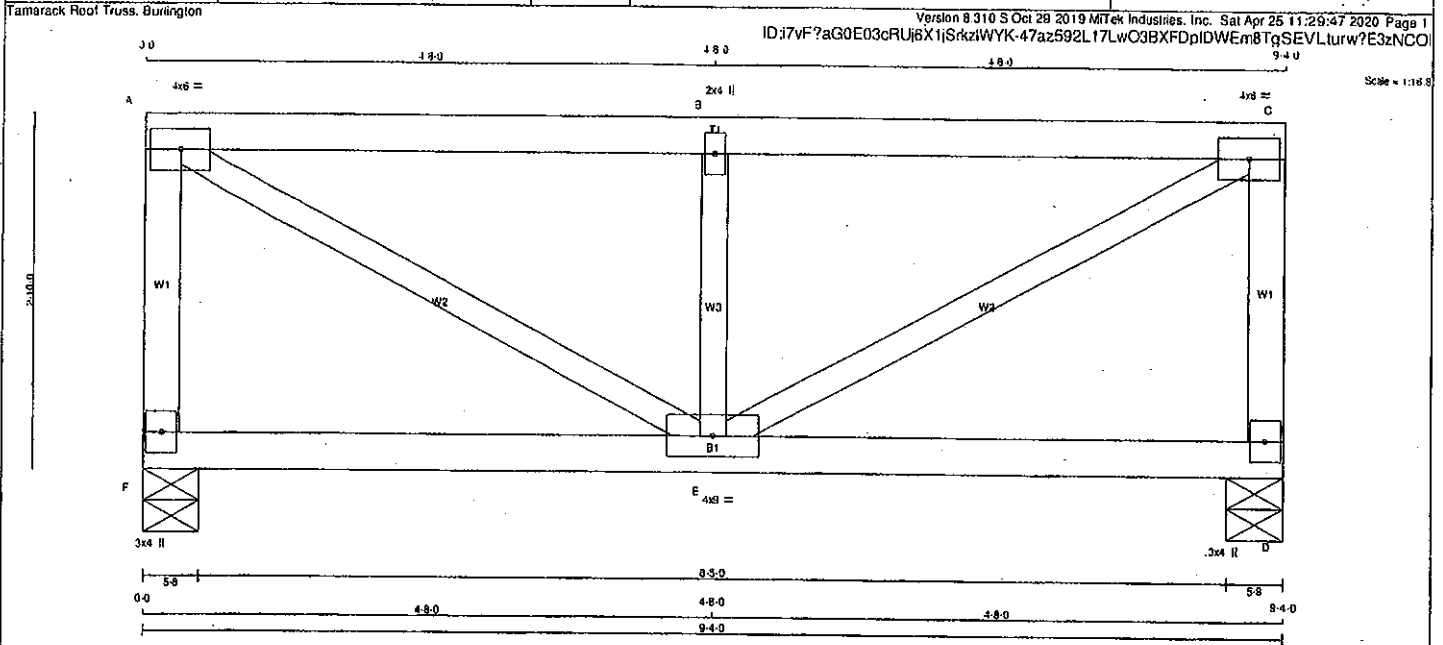

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR.
F - A 2x4 DRY No.2 SPF
A - C 2x4 DRY No.2 SPF
D - C 2x4 DRY No.2 SPF
F - D 2x4 DRY No.2 SPF
ALL WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	4.0	6.0		
B	TMVW-w	MT20	2.0	4.0		
C	TMVW-t	MT20	4.0	6.0		
D	BMV1-p	MT20	3.0	4.0		
E	BMVW-w-t	MT20	4.0	9.0		
F	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
F	620	0	620	0	5-8	5-8
D	620	0	620	0	5-8	5-8

UNFACTORED REACTIONS

MAX/MIN COMPONENT REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	448	239 / 0	0 / 0	0 / 0	0 / 0	209 / 0	0 / 0
D	448	239 / 0	0 / 0	0 / 0	0 / 0	209 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.52 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)
F-A	-583 / 0	0.0	0.0	0.11 (1)	7.81	0.0	0.11 (1)
A-B	-895 / 0	-114.3	-114.3	0.55 (1)	5.52	-858 / 0	0.15 (1)
B-C	-895 / 0	-114.3	-114.3	0.55 (1)	5.52	0.0	0.11 (1)
D-C	-583 / 0	0.0	0.0	0.11 (1)	7.81	0.0	0.11 (1)
F-E	0 / 0	-18.5	-18.5	0.13 (4)	10.00	0.0	0.13 (4)
E-D	0 / 0	-18.5	-18.5	0.13 (4)	10.00	0.0	0.13 (4)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
OL	= 15.0 PSF
BOT CH. LL	= 0.0 PSF
OL	= 7.4 PSF
TOTAL LOAD	= 48.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.31")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.31")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.55/1.00 (B-C:1), BC=0.13/1.00 (E-F:4), WS=0.24/1.00 (A-E:1), SS=0.34/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PL)	MAX MIN	MAX MIN	MAX MIN
MT20	610	354	1687	788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.61 (A) (INPUT = 0.90)
JSI METAL = 0.24 (A) (INPUT = 1.00)

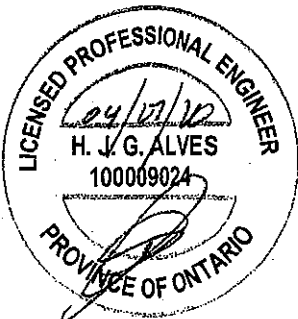

Structural component only
DWG#-T-2007-120

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC	DRWG NO.
408152	G52	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:28 2020 Page 1
ID:7vF?aG0E03cRU8X1tSikzIWK-7Twn6pQVHydc8EiejlyWyePpDiHyU4WOpv3fzNCOB

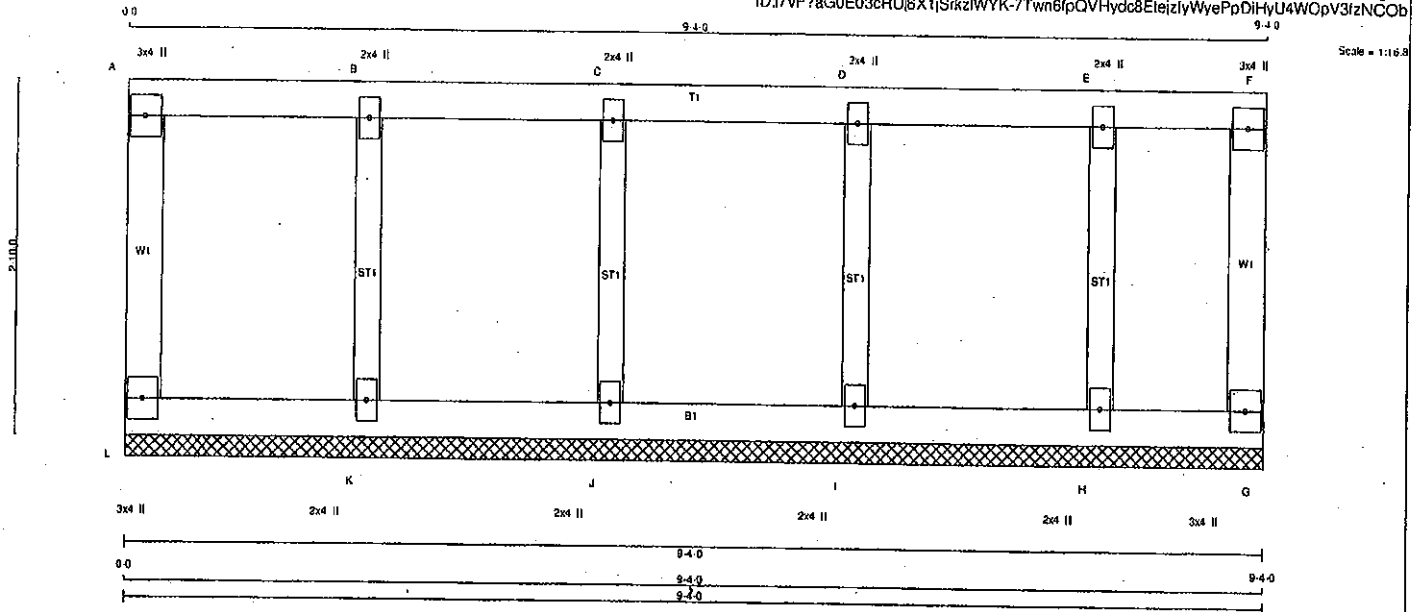

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
L - A	2x4	DRY	No.2	
A - F	2x4	DRY	No.2	
G - F	2x4	DRY	No.2	
L - G	2x4	DRY	No.2	

ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B, C, D, E						
B	TMV+w	MT20	2.0	4.0		
F	TMV+p	MT20	3.0	4.0		
G	BMV1+p	MT20	3.0	4.0		
H, I, J, K						
H	BMV1+w	MT20	2.0	4.0		
L	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	LC1 MAX (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
L-A	-101 / 0	0.0	0.0 0.03 (1)	7.81	K-B	-245 / 0	0.06 (1)
A-B	-8 / 0	-114.3	-114.3 0.08 (1)	10.00	J-C	-224 / 0	0.05 (1)
B-C	-8 / 0	-114.3	-114.3 0.08 (1)	10.00	I-D	-237 / 0	0.05 (1)
C-D	-8 / 0	-114.3	-114.3 0.07 (1)	10.00	H-E	-196 / 0	0.04 (1)
D-E	-8 / 0	-114.3	-114.3 0.07 (1)	10.00			
E-F	-8 / 0	-114.3	-114.3 0.05 (1)	10.00			
G-F	-64 / 0	0.0	0.0 0.02 (1)	7.81			
L-K	0 / 8	-18.5	-18.5 0.02 (4)	10.00			
K-J	0 / 8	-18.5	-18.5 0.02 (4)	10.00			
J-I	0 / 8	-18.5	-18.5 0.02 (4)	10.00			
I-H	0 / 8	-18.5	-18.5 0.02 (4)	10.00			
H-G	0 / 8	-18.5	-18.5 0.02 (1)	10.00			

TOTAL WEIGHT = 34 lb [M/R]

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	15.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	48.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.08/1.00 (A-B:1), BC=0.02/1.00 (K-L:4), WB=0.06/1.00 (B-K:1), SS=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PLI)	SECTION (PLI)
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1687 788 1987 1656	


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.17 (K) (INPUT = 0.90)
JSI METAL = 0.07 (K) (INPUT = 1.00)



Structural component only
DWG# T-2007104

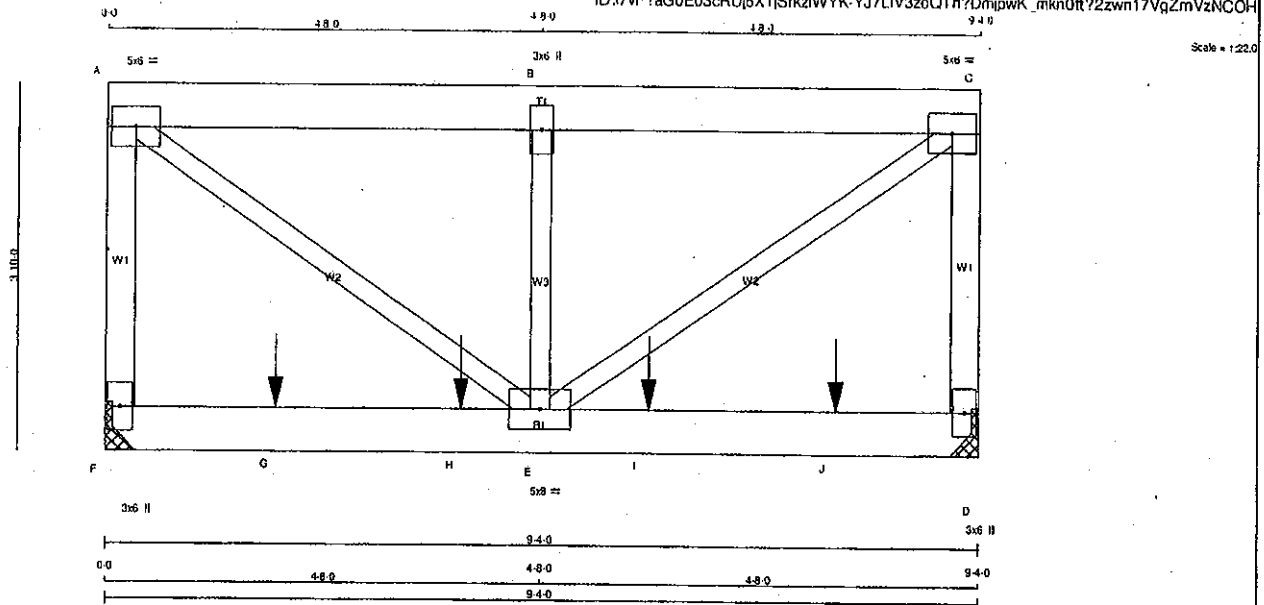

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
F - A	2x4	DRY No.2
A - C	2x8	DRY No.2
D - C	2x4	DRY No.2
F - D	2x8	DRY No.2

ALL WEBS 2x3 DRY No.2
 DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMW+4	MT20	5.0	6.0		
B	TMW+4	MT20	3.0	6.0		
C	TMW+4	MT20	5.0	6.0		
D	BMV+4	MT20	3.0	6.0		
E	BMVWW+4	MT20	5.0	6.0		
F	BMV+4	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING

BEARINGS

JT	FACTORED		MAXIMUM FACTORED		INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG		
F	988	0	988	0	0	MECHANICAL
D	1012	0	1012	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D. MINIMUM BEARING LENGTH AT JOINT F = 3-8, JOINT D = 3-8.

UNFACTORED REACTIONS

1ST LOASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	705	427 / 0	0 / 0	0 / 0	0 / 0	279 / 0	0 / 0
D	722	439 / 0	0 / 0	0 / 0	0 / 0	283 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 MAX. (LC)	MAX. FACTORED UNBRACED LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
F-A	-846/0	0.0	0.0 0.23 (1)	7.45	A-E	0/1072	0.35 (1)
A-B	-889/0	-114.3	-114.3 0.24 (1)	6.25	E-B	-632/0	0.18 (1)
B-C	-889/0	-114.3	-114.3 0.24 (1)	6.25	E-C	0/1072	0.35 (1)
D-C	-846/0	0.0	0.0 0.23 (1)	7.45			
F-G	0/0	-18.5	-18.5 0.24 (1)	10.00			
G-H	0/0	-18.5	-18.5 0.24 (1)	10.00			
H-E	0/0	-18.5	-18.5 0.24 (1)	10.00			
E-I	0/0	-18.5	-18.5 0.24 (1)	10.00			
I-J	0/0	-18.5	-18.5 0.24 (1)	10.00			
J-D	0/0	-18.5	-18.5 0.24 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	1-9-12	-190	-190	---	FRONT	VERT	TOTAL	---	C1
H	3-9-12	-190	-190	---	FRONT	VERT	TOTAL	---	C1
I	5-9-12	-190	-190	---	FRONT	VERT	TOTAL	---	C1
J	7-9-12	-190	-190	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 15.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 48.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.31")
 CALCULATED VERT. DEFL.(LL) = $L/999$ (0.02")
 ALLOWABLE DEFL.(TL) = $L/360$ (0.31")
 CALCULATED VERT. DEFL.(TL) = $L/998$ (0.04")

CSI: TC=0.24/1.00 (B-C:1), BC=0.24/1.00 (D-E:1),
 WB=0.35/1.00 (A-E:1), SS=0.29/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00
 FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.76 (E) (INPUT = 0.90)
 JSI METAL = 0.32 (E) (INPUT = 1.00)



Structural component only
 DWG# T-2007121

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	T54	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 11:29:50 2020 Page 1					
ID:7vF7aG0E03cRU[8X1]SrkziWYK-UIF5[A4DJ2]VFWw6xLMS9sN4hadRnVJap9frOzNCOF					
Scale = 1:25					

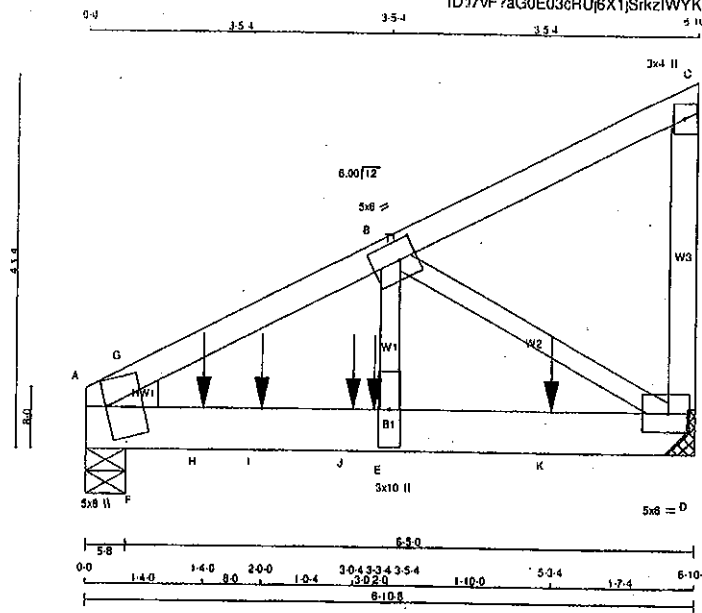

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	
A - D	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
C - D	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
A - D	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TBMH1+m	MT20	5.0	8.0	3.50
B	TMWW1-t	MT20	5.0	6.0	2.50 2.25
C	TMV+p	MT20	3.0	4.0	
D	BMVW1-t	MT20	5.0	6.0	2.50 2.75
E	BMV+w	MT20	3.0	10.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	HEEL WEDGE
JT	VERT	HORIZ	DOWN	HORIZ	UPLIFT
A	3467	0	3467	0	0
D	2454	0	2454	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4'-0".

UNFACTORED REACTIONS

	1ST LOASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED						
A	2449	1622 / 0	0 / 0	0 / 0	0 / 0	828 / 0	0 / 0
D	1735	1144 / 0	0 / 0	0 / 0	0 / 0	591 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.16 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO							
A-G	-4978 / 0	-91.8	-91.8	0.19 (1)	4.16	E-B	0 / 3365
G-B	-3863 / 0	-91.8	-91.8	0.17 (1)	4.66	B-D	-4035 / 0
B-C	-13 / 0	-91.8	-91.8	0.07 (1)	6.25	F-G	0 / 1740
D-C	-129 / 0	0.0	0.0	0.02 (1)	7.81		
A-F	0 / 3490	-18.5	-18.5	0.25 (1)	10.00		
F-H	0 / 3490	-18.5	-18.5	0.68 (1)	10.00		
H-I	0 / 3490	-18.5	-18.5	0.68 (1)	10.00		
I-J	0 / 3490	-18.5	-18.5	0.68 (1)	10.00		
J-E	0 / 3490	-18.5	-18.5	0.68 (1)	10.00		
E-K	0 / 3490	-18.5	-18.5	0.49 (1)	10.00		
K-D	0 / 3490	-18.5	-18.5	0.49 (1)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LOC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
H	1-4-0	-1378	-1378		BACK	VERT	TOTAL		C1
I	2-0-0	-1000	-1000		FRONT	VERT	TOTAL		C1
J	3-0-4	-994	-994		FRONT	VERT	TOTAL		C1
K	3-3-4	-898	-898		BACK	VERT	TOTAL		C1
	5-3-4	-898	-898		BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 30 = 60 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	= 26.8	PSF
	DL	= 8.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. GC

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.23")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.23")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.19/1.00 (A-G:1), BC=0.68/1.00 (E-F:1), WB=0.53/1.00 (B-D:1), SS=0.90/1.00 (E-F:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354
	1667	788
	1987	1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (B) (INPUT = 0.90)

JSI METAL= 0.70 (A) (INPUT = 1.00)



Structural component only
DWG# T-2007122

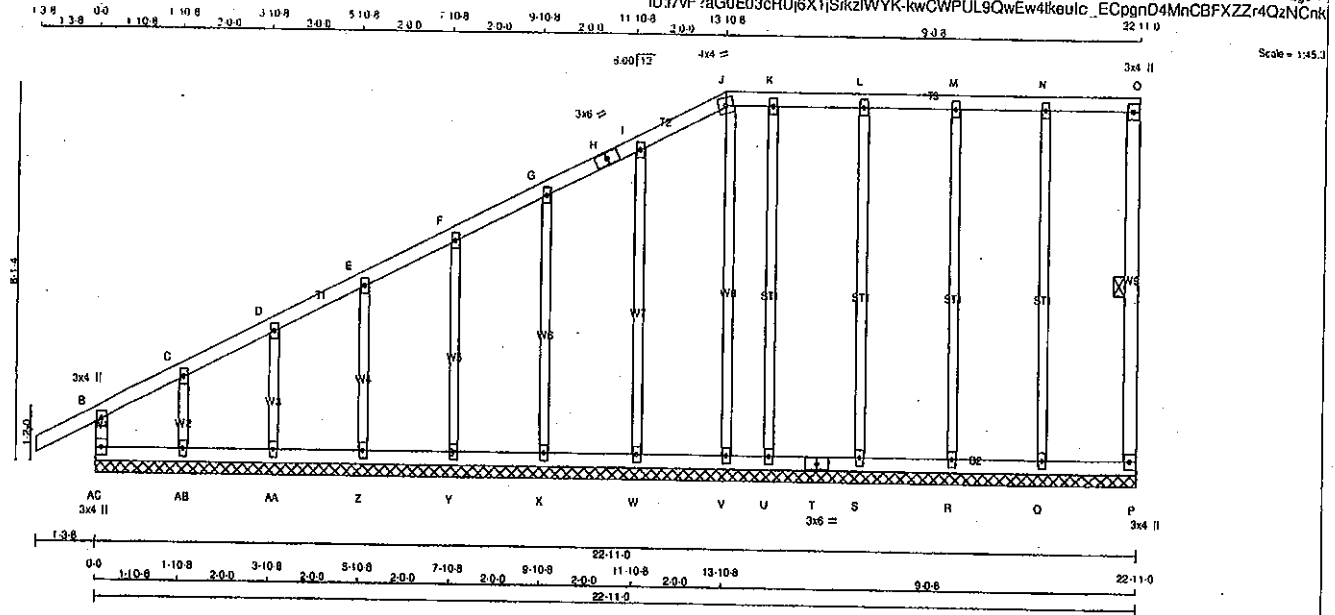

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	LUMBER	DESCR.
AC - B	2x4	DRY No.2	SPF
A - H	2x4	DRY No.2	SPF
H - J	2x4	DRY No.2	SPF
J - O	2x4	DRY No.2	SPF
P - O	2x4	DRY No.2	SPF
AC - T	2x4	DRY No.2	SPF
T - P	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
ALL GABLE WEBS	2x3	DRY No.2	SPF
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C, D, E, F, G, I, K, L, M, N					
C TMW+w	MT20	2.0	4.0		
H TS-t	MT20	3.0	6.0		
J TTW-m	MT20	4.0	4.0		
O TMV+p	MT20	3.0	4.0		
P BMV+p	MT20	3.0	4.0		
Q, R, S, U, V, W, X, Y, Z, AA, AB					
Q BMV+w	MT20	2.0	4.0		
T BS-t	MT20	3.0	6.0		
AC BMV+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF O-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)		MAX. UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
		FROM	TO			
FR-TO						
AC-B	-224/0	0.0	0.0	0.02 (1)	7.81	0.25 (1)
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00	0.23 (1)
B-C	-26/0	-91.8	-91.8	0.04 (1)	6.25	0.24 (1)
C-D	-19/0	-91.8	-91.8	0.04 (1)	6.25	0.17 (1)
D-E	-15/0	-91.8	-91.8	0.04 (1)	6.25	0.17 (1)
E-F	-11/0	-91.8	-91.8	0.04 (1)	6.25	0.17 (1)
F-G	-8/0	-91.8	-91.8	0.04 (1)	10.00	0.11 (1)
G-H	-8/0	-91.8	-91.8	0.04 (1)	10.00	0.07 (1)
H-I	-6/0	-91.8	-91.8	0.04 (1)	10.00	0.05 (1)
I-J	-6/0	-91.8	-91.8	0.04 (1)	10.00	0.03 (1)
J-K	-2/0	-91.8	-91.8	0.03 (1)	10.00	0.03 (1)
K-L	-2/0	-91.8	-91.8	0.04 (1)	10.00	
L-M	-2/0	-91.8	-91.8	0.04 (1)	10.00	
M-N	-2/0	-91.8	-91.8	0.04 (1)	10.00	
N-O	-2/0	-91.8	-91.8	0.04 (1)	10.00	
P-O	-81/0	0.0	0.0	0.01 (1)	6.25	
AC-AB	0/24	-18.5	-18.5	0.02 (4)	10.00	
AB-AA	0/17	-18.5	-18.5	0.02 (4)	10.00	
AA-Z	0/13	-18.5	-18.5	0.02 (4)	10.00	
Z-Y	0/10	-18.5	-18.5	0.02 (4)	10.00	
Y-X	0/7	-18.5	-18.5	0.01 (4)	10.00	
X-W	0/5	-18.5	-18.5	0.02 (4)	10.00	
W-V	0/4	-18.5	-18.5	0.02 (4)	10.00	
V-U	0/2	-18.5	-18.5	0.01 (4)	10.00	
U-T	0/2	-18.5	-18.5	0.02 (4)	10.00	
T-S	0/2	-18.5	-18.5	0.02 (4)	10.00	
S-R	0/2	-18.5	-18.5	0.02 (4)	10.00	
R-Q	0/2	-18.5	-18.5	0.02 (4)	10.00	
Q-P	0/2	-18.5	-18.5	0.02 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (Q-R:4), WB=0.25/1.00 (N-Q:1), SS=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.60 (J) (INPUT = 0.90)

JSI METAL= 0.08 (I) (INPUT = 1.00)



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408150	GP1	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:02:40 2020 Page 1
 ID:7vF7aG0E03cRUj6X1jSkzIWYK-C6mudqMnBDMnh0JqS07DnQMfncNpWgWOMDIPdszNCri

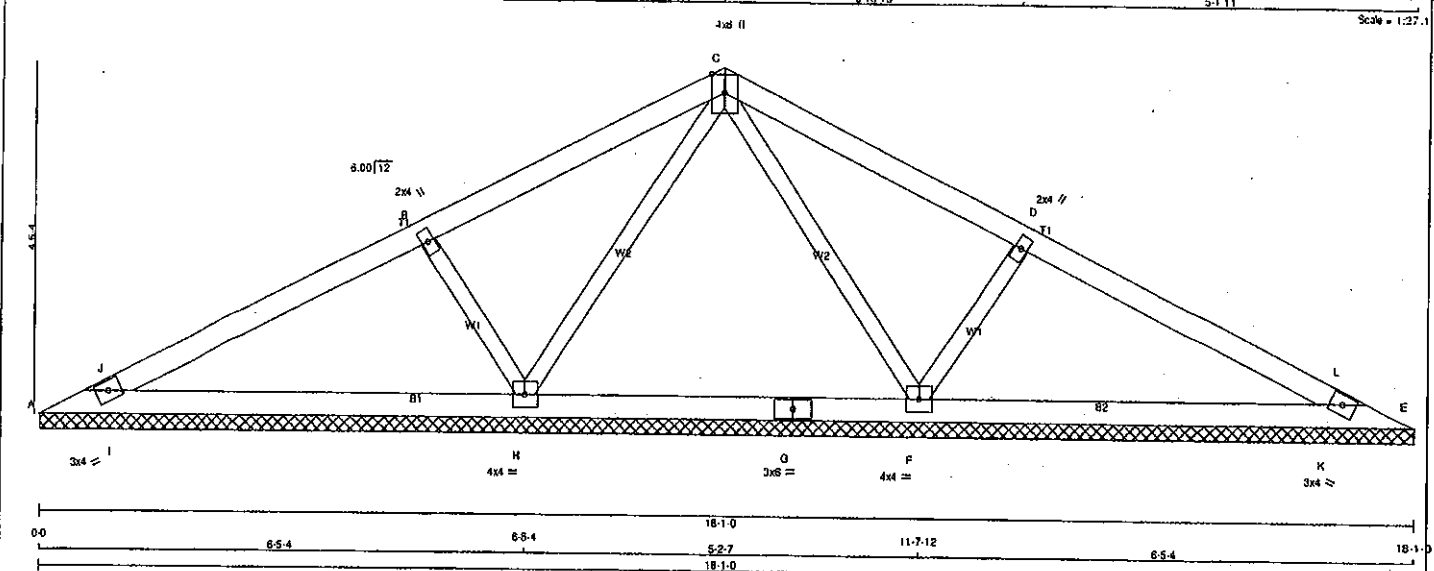

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
A - G	2x4	DRY	No.2	SPF	
G - E	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE	PLATES			
A - TBMT-h	MT20	3.0	4.0	
B - TMW-w	MT20	2.0	4.0	
C - TTWW-w	MT20	4.0	6.0	Edge
D - TMW-w	MT20	2.0	4.0	
E - TBMT-h	MT20	3.0	4.0	
F - BMWW-I	MT20	4.0	4.0	
G - BS-I	MT20	3.0	6.0	
H - BMWW-I	MT20	4.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		RECORD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG	BRG
A	134	0	134	0	0	18-1-0 (9-11-18)1-0	18-1-0 (9-11-18)1-0		
E	134	0	134	0	0	18-1-0 (9-11-18)1-0	18-1-0 (9-11-18)1-0		
F	883	0	883	0	0	18-1-0 (9-11-18)1-0	18-1-0 (9-11-18)1-0		
H	883	0	883	0	0	18-1-0 (9-11-18)1-0	18-1-0 (9-11-18)1-0		

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	94	687/0	0/0	0/0	0/0	287/0	0/0
E	94	687/0	0/0	0/0	0/0	287/0	0/0
F	611	3957/0	0/0	0/0	0/0	2187/0	0/0
H	611	3957/0	0/0	0/0	0/0	2187/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, F, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-J	07240	-91.8 -91.8 0.12 (1)	10.00	C-F	-4287/0	0.18 (1)	
J-B	07301	-91.8 -91.8 0.34 (1)	10.00	F-D	-4367/0	0.08 (1)	
B-C	07503	-91.8 -91.8 0.37 (1)	10.00	H-C	-4287/0	0.18 (1)	
C-D	07503	-91.8 -91.8 0.37 (1)	10.00	B-H	-4367/0	0.08 (1)	
D-L	07301	-91.8 -91.8 0.34 (1)	10.00	I-J	-76735	0.00 (1)	
L-E	07240	-91.8 -91.8 0.12 (1)	10.00	K-L	-76735	0.00 (1)	
A-I	-2557/0	-18.5 -18.5 0.11 (1)	6.25				
I-H	-2437/0	-18.5 -18.5 0.13 (4)	6.25				
H-G	-2487/0	-18.5 -18.5 0.13 (4)	6.25				
G-F	-2487/0	-18.5 -18.5 0.13 (4)	6.25				
F-K	-2437/0	-18.5 -18.5 0.13 (4)	6.25				
K-E	-2557/0	-18.5 -18.5 0.11 (1)	6.25				

TOTAL WEIGHT = 2 X 54 = 107 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENOMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.377/1.00 (C-D:1), BC=0.137/1.00 (F-K:4),
 WB=0.187/1.00 (C-H:1), SS=0.177/1.00 (D-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PL) (PL)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1658


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.48 (H) (INPUT = 0.90)
 JSI METAL = 0.15 (C) (INPUT = 1.00)



Structural component only
 DWG# T-2007058

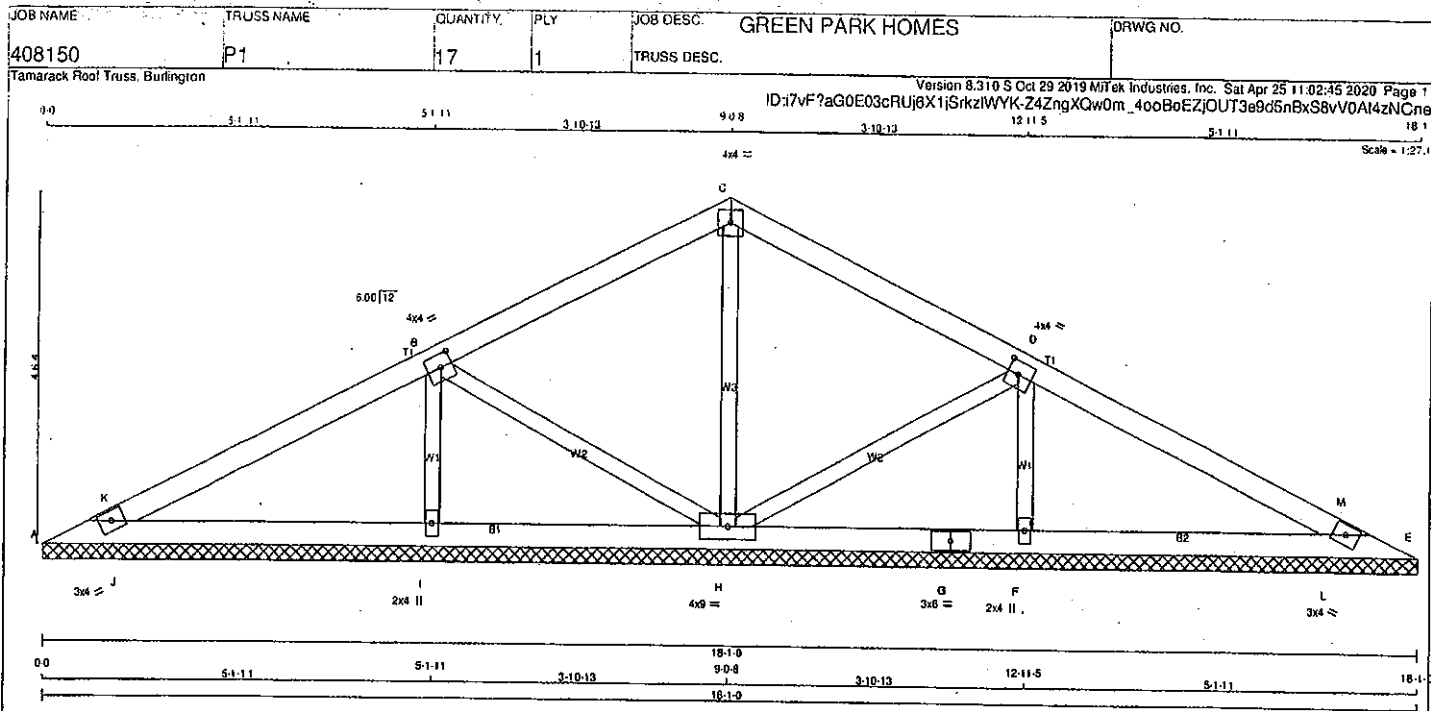

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
A - G	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B	TBM1-h	MT20	4.0	4.0	2.00	1.75
C	TBM1-h	MT20	4.0	4.0		
D	TBM1-h	MT20	4.0	4.0	2.00	1.75
E	TBM1-h	MT20	3.0	4.0		
F	TBM1-h	MT20	2.0	4.0		
G	BS-1	MT20	3.0	6.0		
H	BS-1	MT20	4.0	9.0		
I	BS-1	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
A	124	0	124	0	18-1-0 (11-11) 18-1-0	18-1-0 (11-11) 18-1-0
E	124	0	124	0	18-1-0 (11-11) 18-1-0	18-1-0 (11-11) 18-1-0
H	415	0	415	0	18-1-0 (11-11) 18-1-0	18-1-0 (11-11) 18-1-0
F	666	0	666	0	18-1-0 (11-11) 18-1-0	18-1-0 (11-11) 18-1-0
I	666	0	666	0	18-1-0 (11-11) 18-1-0	18-1-0 (11-11) 18-1-0

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	COMBINED	MAX/MIN COMPONENT REACTIONS		WIND	DEAD	SOIL
		SNOW	LIVE			
A	87	58/0	0/0	0/0	28/0	0/0
E	87	58/0	0/0	0/0	28/0	0/0
H	293	192/0	0/0	0/0	101/0	0/0
F	471	307/0	0/0	0/0	164/0	0/0
I	471	307/0	0/0	0/0	164/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, H, F, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO		LENGTH	FR-TO		
A-K	0/248	-91.8	-91.8 0.07 (1)	10.00	H-C	-445/0	0.13 (1)
K-B	0/292	-91.8	-91.8 0.32 (1)	10.00	H-D	0/59	0.01 (1)
B-C	0/188	-91.8	-91.8 0.30 (1)	10.00	F-D	-526/0	0.08 (1)
C-D	0/168	-91.8	-91.8 0.30 (1)	10.00	B-H	0/59	0.01 (1)
D-M	0/292	-91.8	-91.8 0.32 (1)	10.00	I-B	-526/0	0.08 (1)
M-E	0/248	-91.8	-91.8 0.07 (1)	10.00	J-K	-128/6	0.00 (1)
					L-M	-128/6	0.00 (1)
A-J	-256/0	-18.5	-18.5 0.14 (1)	6.25			
J-I	-240/0	-18.5	-18.5 0.14 (1)	6.25			
I-H	-240/0	-18.5	-18.5 0.11 (1)	6.25			
H-G	-240/0	-18.5	-18.5 0.11 (1)	6.25			
G-F	-240/0	-18.5	-18.5 0.11 (1)	6.25			
F-L	-240/0	-18.5	-18.5 0.14 (1)	6.25			
L-E	-256/0	-18.5	-18.5 0.14 (1)	6.25			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.32/1.00 (D-M:1), BC=0.14/1.00 (F-L:1), WB=0.13/1.00 (C-H:1), SSI=0.17/1.00 (D-M:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.51 (B) (INPUT = 0.90)
JSI METAL = 0.13 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007062



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408150	U1	21	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:02:42 2020 Page 1
ID:17vF?aG0E03cRUj6X1S/kzIWYK-9Vt1WN1jrcVxKT0Zr9hsrR4TQ3l_cmhDXnWhizNCnh

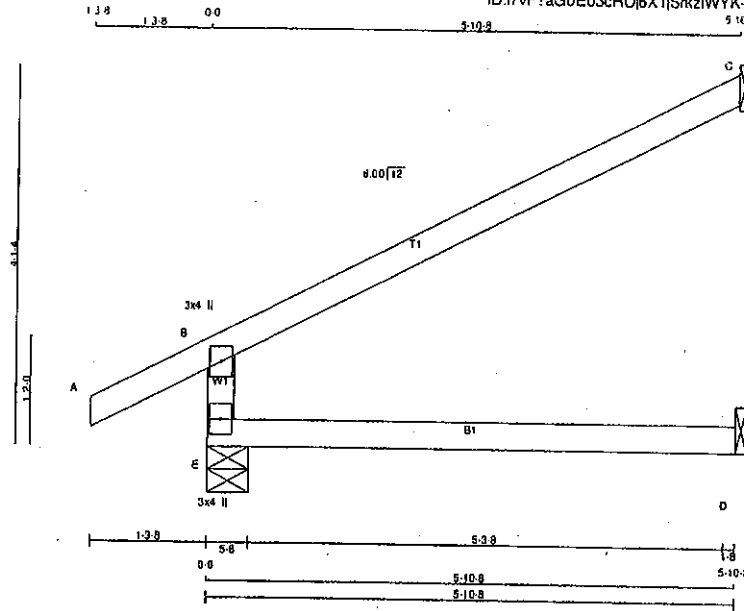

Scale = 1/22.9

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	
CHOROS		No.2	
E - B	2x4 DRY	No.2	
A - C	2x4 DRY	No.2	
E - D	2x4 DRY	No.2	

DRY, SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
E	525	0	525	0	0	5-8	5-8	5-8	5-8
C	202	0	202	0	0	1-8	1-8	1-8	1-8
D	45	0	50	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST LCASE MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	389	257 / 0	0 / 0	0 / 0	0 / 0	111 / 0	0 / 0
C	199	113 / 0	0 / 0	0 / 0	0 / 0	26 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD LC1	MAX (PLF)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX (PLF)
FR-TO		FROM	TO		FR-TO		
E-B	-461 / 0	0.0	0.0 0.13 (4)	7.81			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00			
B-C	-30 / 0	-91.8	-91.8 0.54 (1)	6.25			
E-D	0 / 0	-18.5	-18.5 0.13 (4)	10.00			

TOTAL WEIGHT = 21 X 17 = 353 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 6.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2018
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CS: TC=0.64/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (A:0), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1867 788	1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.19 (E) (INPUT = 0.90)
JSI METAL = 0.13 (B) (INPUT = 1.00)

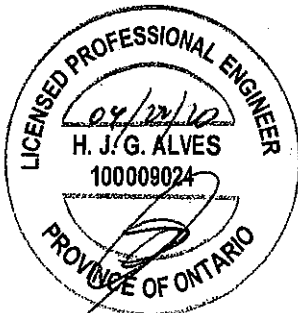

Structural component only
DWG# T-2007059

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408150	J2	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version B.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:02:33 2020 Page 1
ID:17vF?aG0E03cRUJ6X1SrKzIWYK-dhR1FrOIU8kMYU2P78qWp2_KzqQl30rSBX3DBzNCng

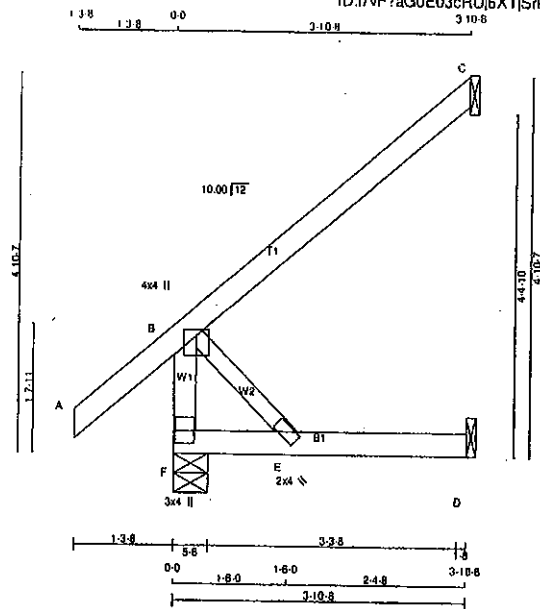

Scale = 1/2" = 1'-0"

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	JT	VERT	BRG		BRG	
F	341	F	341	5-8		5-8	
C	178	C	178	1-8		1-8	
D	38	D	40	1-8		1-8	

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		MAX/MIN. COMPONENT REACTIONS	
1ST LCASE		SNOW	LIVE
JT	COMBINED		
F	239	170/0	0/0
C	122	99/0	0/0
D	29	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PL)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
F-B	-305/0	0.0	0.0 0.03 (1)	F-E	0/0	0.00 (1)	
A-B	0/41	-91.8	-91.8 0.14 (5)				
B-C	0/0	-91.8	-91.8 0.23 (1)				
F-E	0/0	-18.5	-18.5 0.08 (4)				
E-D	0/0	-18.5	-18.5 0.08 (4)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.10")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.10")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.01")

CSI: TC=0.23/1.00 (B-C:1), BC=0.08/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.24 (B) (INPUT = 0.99)
JSI METAL= 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007060

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 11:02:44 2020 Page
ID:7vF?aG0E03cRUj6X1jSrkzWYK-5u?PSBPiFSSDAedbhsB9xGWUuEIBSWG_hrGcmdzNCnf



DRY: SEASONED LUMBER.

BEARINGS

SEE MTEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

LOADING

TOTAL LOAD CASES: (4)

DESIGN CRITERIA

SPECIFIED LOADS:

SPACING = 24.0 N. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018 , OBC 2012 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (0.19")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.02")
ALLOWABLE DEFL.(TL) = 1/360 (0.19")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.05")

CSI: TC=0.22/1.00 (C-F:1), BC=0.17/1.00 (D-E:1),
WB=0.00/1.00 (E-F:1), SSI=0.16/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1867	788	1987	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.24 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	J40	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:29 2020 Page 1	

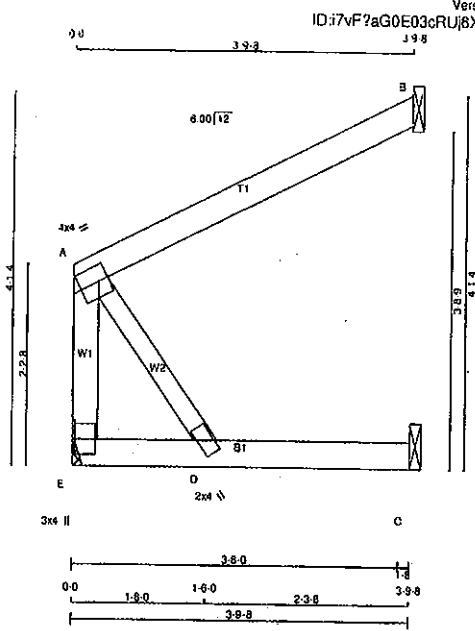

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
E - A	2x4 DRY	No.2	SPF
A - B	2x4 DRY	No.2	SPF
E - C	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW-1	MT20	4.0	4.0	2.00 1.25
D	BMVW-w	MT20	2.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	DOWN	HORIZ	UPLIFT	IN-SX	IN-SX	
E	209	0	209	0	0	MECHANICAL	
B	174	0	174	0	0	1-8	1-8
C	35	0	39	0	0	1-8	1-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-B.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	148	97/0	0/0	0/0	0/0	51/0	0/0
B	120	97/0	0/0	0/0	0/0	23/0	0/0
C	28	0/0	0/0	0/0	0/0	28/0	0/0

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)
FR-TO				FR-TO			
E-A	-174/0	0.0	0.0 0.02 (1)	A-D	0/0	0.00 (1)	
A-B	0/0	-91.8	-91.8 0.22 (1)				
E-D	0/0	-18.5	-18.5 0.07 (4)				
D-C	0/0	-18.5	-18.5 0.08 (4)				

TOTAL WEIGHT = 4 X 13 = 52 lb [M/F]

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.01")

CSI: TC=0.22/1.00 (A-B:1), BC=0.08/1.00 (C-D:4), WB=0.00/1.00 (A-D:1), SS=0.12/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP (DRY)	SHEAR	SECTION	(PSI)	(PLI)
				MAX	MIN
MT20	618	354	1687	788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.11 (A) (INPUT = 0.90)
JSI METAL = 0.93 (A) (INPUT = 1.00)

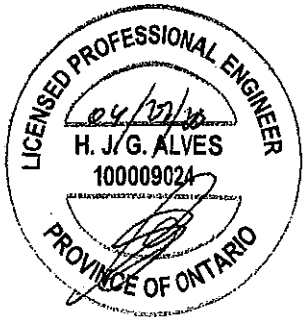

Structural component only
DWG# T-2007105

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	J41	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:31 2020 Page 1
ID:17vF?aG0E03cRUj6X1jSkzIWYK-Y2cwkhJrCKCTbzSJsX?a8a7q0FFUJ5WDM29q_zNCOY

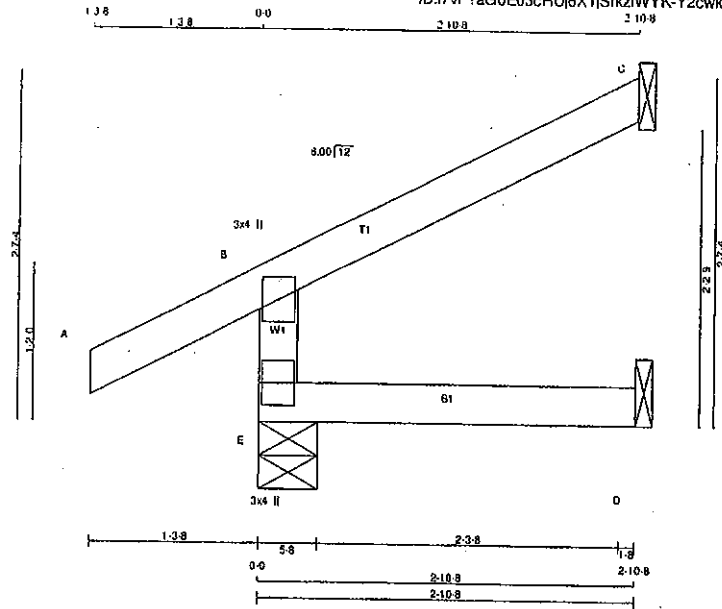

TOTAL WEIGHT = 4 X 10 = 38 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	No.2
E - B	2x4	DRY	No.2			
A - C	2x4	DRY	No.2			
E - D	2x4	DRY	No.2			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
E BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQRD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	319	0	319	0	5-8	5-8
C	99	0	99	0	1-8	1-8
D	23	0	23	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	COMBINED	1ST LCASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
		SNOW	LIVE	PERM. LIVE	IN-SX			
E	223	181/0	0/0	0/0	0/0	0/0	62/0	0/0
C	68	55/0	0/0	0/0	0/0	0/0	13/0	0/0
D	18	0/0	0/0	0/0	0/0	0/0	18/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		FACTORED		WEBS	
	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO						
E-B	-289/0	0.0	0.0	0.02 (4)	7.81	
A-B	0/28	-91.8	-91.8	0.13 (5)	10.00	
B-C	-15/0	-91.8	-91.8	0.13 (1)	6.25	
E-D	0/0	-18.5	-18.5	0.03 (4)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.00")

CSI: TC=0.13/1.00 (B-C:1), BC=0.03/1.00 (D-E:4),
WB=0.00/1.00 (78:0), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.12 (E) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007106

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408150	C1	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 6.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:02:37 2020 Page 1
 ID:7vF?aG0E03cRUJ6X1jSkzIWK-oX4m oJvul_CqZaFmuZV9nkjvPNuJLXy4F4IOXzNCnm

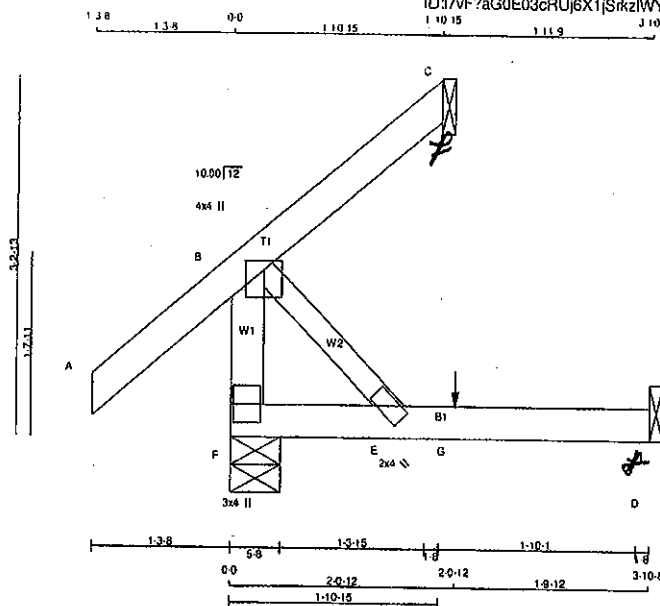

Scale = 1/8" = 1'-0"

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	HORZ	BRG	IN-SX	BRG	IN-SX
F	297	0	297	0	0	5-8	5-8	5-8	5-8
C	42	0	42	0	-36	1-8	1-8	1-8	1-8
D	36	0	40	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS		1ST CASE		MAX/MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
F	208	145/0	0/0	0/0	63/0
C	29	23/-28	0/0	0/0	5/0
D	-29	0/0	0/0	0/0	29/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		MAX. FACTORED		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1	MAX	CS1 (LC)	MEMB.	FORCE (LBS)	MAX	CS1 (LC)
F-B	-281/0	0.0	0.0	0.03 (1)	7.81	B-E	0/0	0.00 (1)	
A-B	0/41	-91.8	-91.8	0.14 (5)	10.00				
B-C	-29/0	-91.8	-91.8	0.14 (5)	6.25				
F-E	0/0	-18.5	-18.5	0.08 (4)	10.00				
E-G	0/0	-18.5	-18.5	0.08 (4)	10.00				
G-D	0/0	-18.5	-18.5	0.08 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)		LOC.		MAX.		FACE		DIR.		TYPE		HEEL		CONN.	
JT	LOC.	LC1	MAX-	MAX+		BACK	VERT			TOTAL					C1
G	2-0-12	1	1												

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBCC 2010, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 086-14
 - TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
 - OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
 ALLOWABLE DEFL.(TL) = L/360 (0.19")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CS1: TC=0.14/1.00 (A-B-S), BC=0.08/1.00 (D-E-4), WB=0.00/1.00 (B-E-1), SS=0.09/1.00 (A-B-S)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1867 768 1887 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.20 (8) (INPUT = 0.90)
 JSI METAL= 0.05 (8) (INPUT = 1.00)



Structural component only
 DWG# T-2007055

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC	DRWG NO.
408150	C2	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:02:38 2020 Page 1
ID:17vF?ag0E03cRUj6X1jSrKzIWYK-Gke8C8KXfc63Sj9SKb4l7GVwpk52on6lvpIY_zNCnI

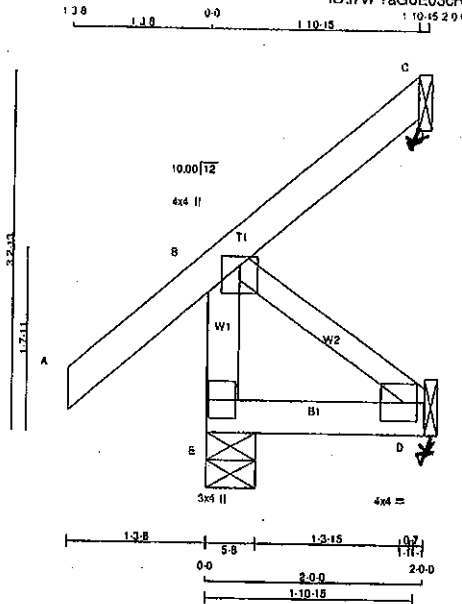

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
D	BMV1-i	MT20	4.0	4.0	2.00 1.25
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	UP/LIFT	IN-SX	BRG	IN-SX
E	278	0	278	0	0	5-8	5-8	5-8	5-8
C	42	0	42	0	-36	1-8	1-8	1-8	1-8
D	18	0	20	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS		1ST CASE		MAX/MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
E	194	145/0	0/0	0/0	0/0
C	29	23/-26	0/0	0/0	0/0
D	14	0/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED (LC) UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO	
E-B	-281/0	0.0	0.0 0.03 (1)	B-D	0/0
A-B	0/41	-91.8	-91.8 0.13 (1)		
B-C	-29/0	-91.8	-91.8 0.12 (1)		
E-D	0/0	-18.5	-18.5 0.02 (4)		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 10 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TFC 2011, TFC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.13/1.00 (A-B:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (B-D:1), SS=0.08/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES		PLATE GRIP (DRY)		SHEAR		SECTION	
(PSI)	(PLI)	(PSI)	(PLI)	(PSI)	(PLI)	(PSI)	(PLI)
MT20	818	354	1687	788	1987	1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.20 (B) (INPUT = 0.80)
JSI METAL= 0.05 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007056

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	C40	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:21 2020 Page 1
ID:7vF?ag0E03cRUj6X1jSkzWYK-q778eGk1873dG3CXkLiA19P1_o08nd2voddJZzNCO

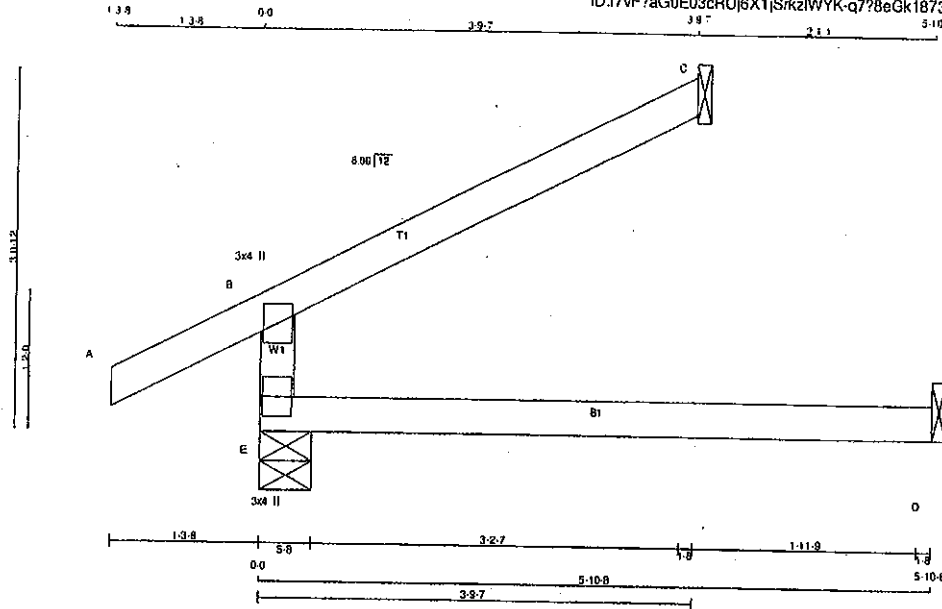

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	No.2
E - B	2x4	DRY	No.2			
A - C	2x4	DRY	No.2			
E - D	2x4	DRY	No.2			

DRY: SEASONED LUMBER.

PLATES (table/s in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV1p	MT20	3.0	4.0		
E	BMV1p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
E	405	0	405	0	5-8	5-8
C	130	0	130	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL 697791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	286	190/0	0/0	0/0	0/0	98/0	0/0
C	90	73/0	0/0	0/0	0/0	17/0	0/0
D	36	0/0	0/0	0/0	0/0	35/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS			
	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO						
E-B	-342/0	0.0	0.0	0.13 (4)	7.81	
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00	
B-C	-19/0	-91.8	-91.8	0.22 (1)	6.25	
E-D	0/0	-18.5	-18.5	0.13 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL (TL) = $L/999$ (0.03")

CSI: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (NA:0), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007098

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	C41	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:23 2020 Page 1					
ID: i7vF?aG0E03cRUj6X1jSkziWYK-nV7u2yllHjUKVNMvriAN7FSFnyoUmch6LN66kNSzNCCQg					
Scale = 1:13.1					

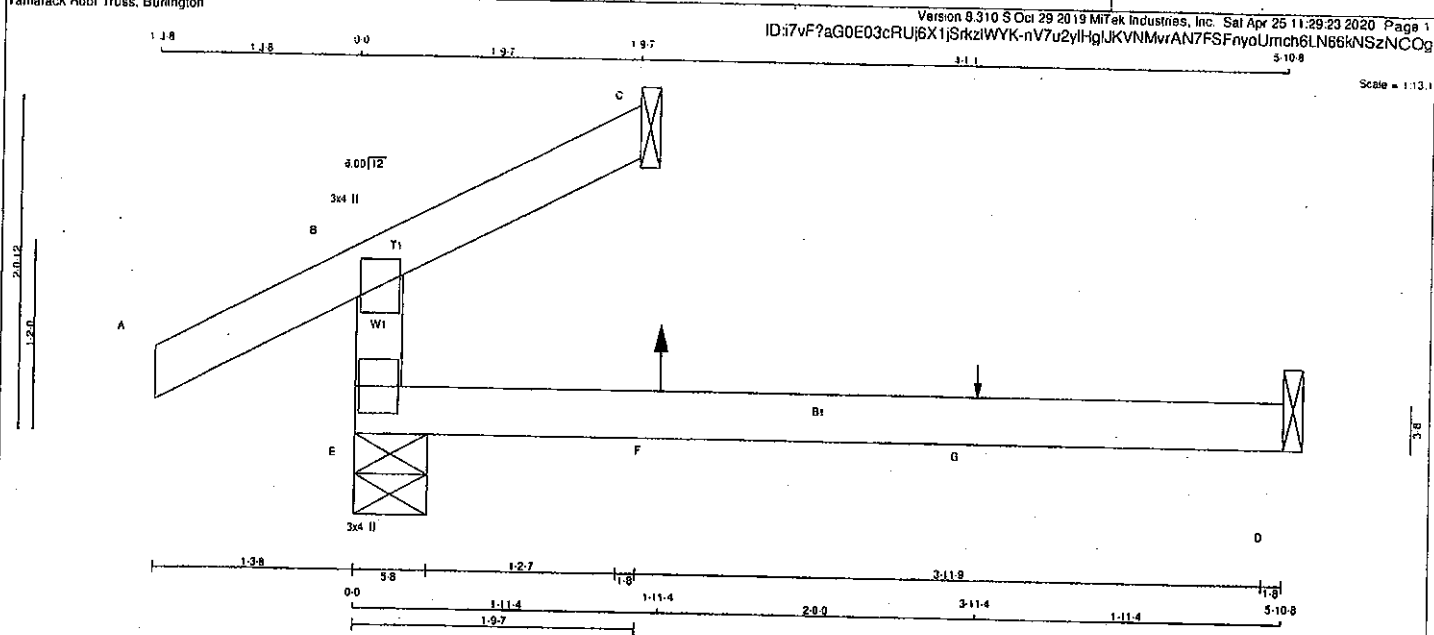

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX		REQD BRG IN-SX	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	BRG	IN-SX
E	284	0	284	0	0	5-8	5-8
C	63	0	63	0	0	1-8	1-8
D	44	0	52	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	200	137/0	0/0	0/0	0/0	82/0	0/0
C	46	21/0	0/0	0/0	0/0	25/0	0/0
D	35	0/-3	0/0	0/0	0/0	37/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (7)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
E-B	-227/0	0.0	0.0 0.11 (4)	7.81			
A-B	0/28	-91.8	-91.8 0.12 (1)	10.00			
B-C	-9/9	-91.8	-91.8 0.08 (4)	10.00			
E-F	0/0	-18.5	-18.5 0.14 (4)	10.00			
F-G	0/0	-18.5	-18.5 0.14 (4)	10.00			
G-H	0/0	-18.5	-18.5 0.14 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE
F	1-11.4	7	1	12	BACK	VERT	TOTAL
G	3-11.4	1	1	---	BACK	VERT	TOTAL

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 4 X 12 = 48 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.04")

CSI: TO=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4), WB=0.00/1.00 (w.a:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)



Structural component only.
DWG# T-2007099

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408152	C42	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:24 2020 Page 1
ID:7vF7aG0E03cRUj6X1JSkzIWYK-FhGGHmvr2R87Xx6PlvMogmw6CsuL8MVcmrHwuzNCO

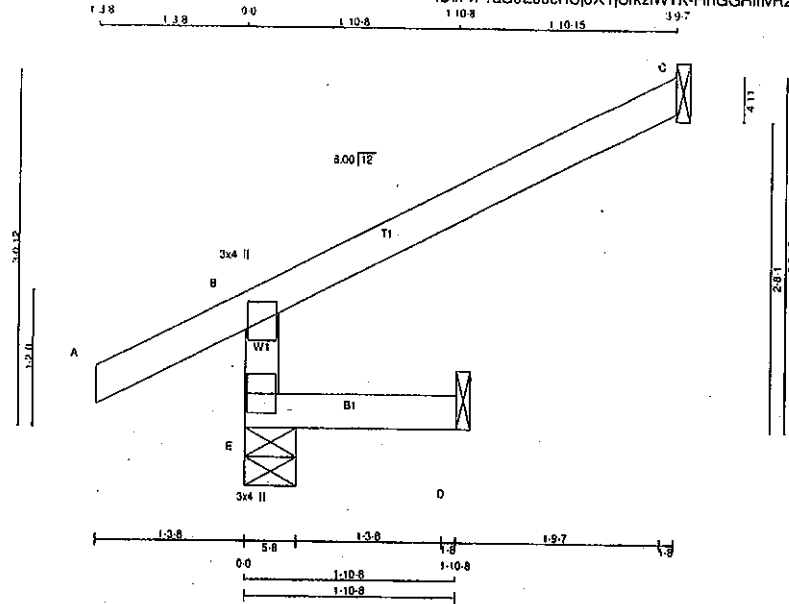

Scale = 1/8"

TOTAL WEIGHT = 4 X 10 = 36 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	IMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

	FACTORED		MAXIMUM FACTORED		INPUT		REQD	
	GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
E	361	0	361	0	0	5-8	5-8	
C	130	0	130	0	0	1-8	1-8	
D	16	0	17	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

	1ST CASE	MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
		SNOW	LIVE			
JT	COMBINED					
E	250	190/0	0/0	0/0	80/0	0/0
C	90	73/0	0/0	0/0	17/0	0/0
D	12	0/0	0/0	0/0	12/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 MAX (PLF) CSI (LC) UNBRAC LENGTH FR-TO	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS) CSI (LC)
FR-TO		FROM TO		
E-B	-342/0	0.0 0.0 0.01 (4) 7.81		
A-B	0/28	-91.8 -91.8 0.13 (5) 10.00		
B-C	-19/0	-91.8 -91.8 0.22 (1) 6.25		
E-D	0/0	-18.5 -18.5 0.02 (4) 10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (A-B:0), SSI=0.15/1.00 (B-C:1)

DDL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 789

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)

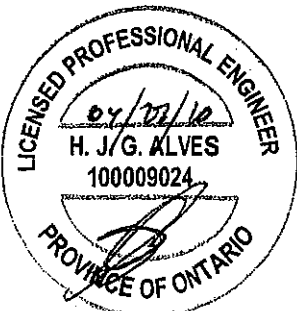


Structural component only
DWG# T-2007100

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	C43	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:25 2020 Page 1
ID:7vF?aG0E03cRUj8X1jSrkzIWK-juETdnYCMa2lgWlzbQbKIK7UcCo4bceqQbrSKzNCOb

Scale = 1/13.1

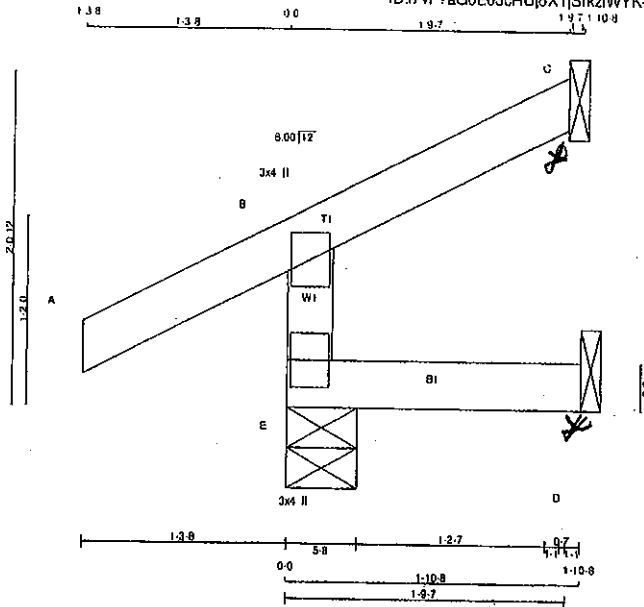

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2	
A - C	2x4	DRY	No.2	
E - D	2x4	DRY	No.2	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	DOWN	HORIZ	DOWN	HORIZ		
E	271	0	271	0	5-8	5-8
C	45	0	45	0	1-8	1-8
D	8	0	17	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

JT	1ST CASE		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
E	158	141/0	0/0	0/0	0/0	47/0	0/0
C	31	24/-18	0/0	0/0	0/0	7/0	0/0
D	7	0/-8	0/0	0/0	0/0	12/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		FACTORED		W E B S	MAX. FACTORED	
	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (PLF)	MAX. (LC)		FORCE (LBS)	MAX. (LC)
FR-TO			FROM	TO			
E-B	-244/0	0.0	0.0	0.04 (5)	7.81		
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00		
B-C	-17/0	-91.8	-91.8	0.09 (1)	6.25		
E-D	0/0	-18.5	-18.5	0.04 (5)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 4 X 7 = 28 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/380 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5),
WB=0.00/1.00 (n/a:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.30)
JSI METAL = 0.07 (B) (INPUT = 1.00)

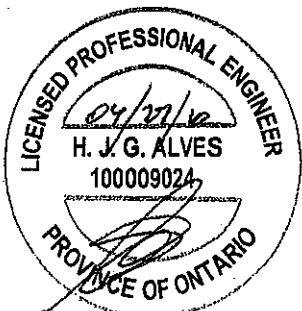

Structural component only
DWG# T-2007101



CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

PLATE ROTATION TOL. = 5.0 Deg




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408152	C45	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 11:29:27 2020 Page 1
ID: i7vF?aG0E03cRUj6X1\$SkzIWYK-IHMPuJookzqm_gH40S3PIPT_PIZYV6xIR4XDXNCOc

Scale = 1/16"

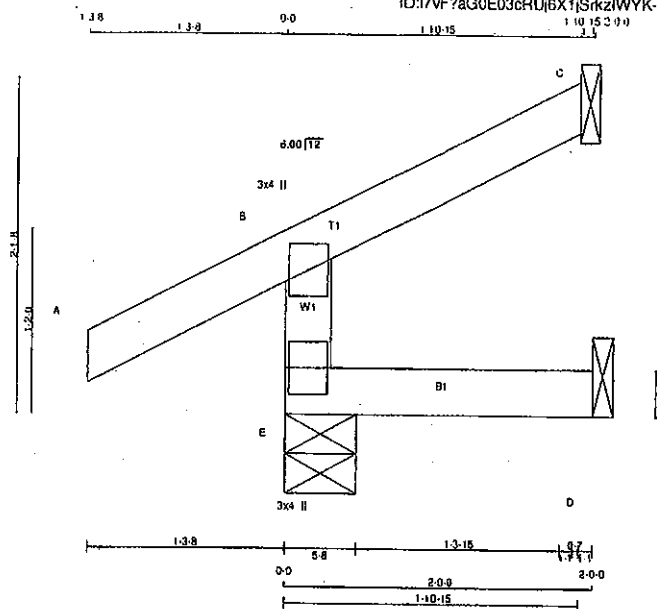

TOTAL WEIGHT = 2 X 7 = 15 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	DOWN	IN-SX	IN-SX
E	254	0	5-8	5-8
C	68	0	1-8	1-8
D	16	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	177	130 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0
C	48	37 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
D	13	0 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (L)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (L)	MEMB.
FR-TO		FROM TO		FR-TO			
E-B	-234 / 0	0.0	0.01 (4)	7.81			
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00		
B-C	-10 / 0	-91.8	-91.8	0.08 (1)	10.00		
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.18")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.18")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007103

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of a) easier installation, b) higher capacities, c) lower installed cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:

- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options Information on p. 126.




Double-Shear Nailing Top View




Double-Shear Nailing Side View; Do not bend tab




Double-Shear Nailing Side View (available on some models)
U.S. Patent 5,603,580

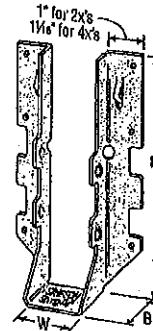


LUS28




LU26L




HUS210
(HUS26, HUS28, and HHUS similar)



HGUS28-2




HHUS210-2



LJS26DS

Typical HUS26 Installation with Reduced Heel Height (Truss Designer to provide fastener quantity for connecting multiple members together)

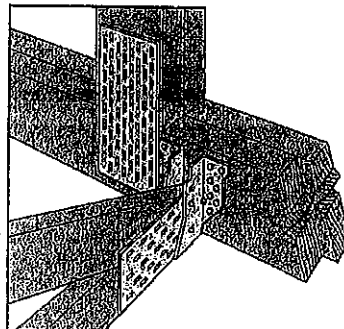

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value

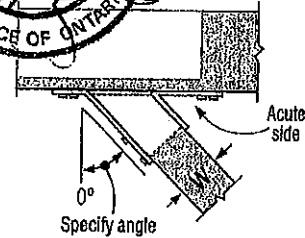

Top View HHUS Hanger Skewed Right
(joist must be bevel cut)
All joist nails installed on the outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	DImensions (In.)				Fasteners		Factored Resistance				
		W	H	B	d _g ³	Header	Joist	D.Fir-L		S-P-F		
								Uplift	Normal	Uplift	Normal	
								(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)	
								lb.	lb.	lb.	lb.	
								kN	kN	kN	kN	
Single 2x Sizes												
SS	LUS24	18	1 1/8	3 1/4	1 3/4	2 1/4	(4) 10d	(2) 10d	710	1625	645	1155
									3.16	7.23	2.87	5.14
SS	LU24L	22	1 1/8	3	1 1/4	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360	1020	320	725
									1.60	4.54	1.42	3.22
SS	LU26L	22	1 1/8	5	1 1/4	4 1/4	(6) 10d	(4) 10d x 1 1/2"	720	1805	645	1140
									3.20	7.14	2.87	5.07
SS	LUS26	18	1 1/8	4 3/4	1 3/4	3 3/4	(4) 10d	(4) 10d	1420	2170	1290	1630
									6.32	9.85	5.74	7.25
SS	HUS26	16	1 1/8	5 1/4	3	3 1/8	(14) 16d	(6) 16d	2705	4940	2065	3875
									11.90	21.97	9.20	17.24
SS	LJS26DS	18	1 1/8	5	3 1/2	4 1/4	(16) 16d	(6) 16d	2055	4265	1460	4115
									9.14	18.97	6.49	18.31
SS	HGUS26	12	1 1/8	5 1/4	5	4 1/4	(20) 16d	(8) 16d	2685	6625	2685	5700
									11.98	29.51	11.86	25.35
SS	LU28L	20	1 1/8	6 3/4	1 1/4	5 1/4	(8) 10d	(6) 10d x 1 1/2"	1140	2185	1020	1550
									5.07	9.72	4.54	6.89
SS	LUS28	18	1 1/8	6 1/4	1 3/4	3 3/4	(6) 10d	(4) 10d	1420	2520	1290	1790
									6.32	11.21	5.74	7.96
SS	HUS28	16	1 1/8	7 1/4	3	6 1/8	(22) 16d	(8) 16d	3605	5366	2675	4345
									16.04	23.86	11.90	19.33
SS	HGUS28	12	1 1/8	7 1/4	5	6 1/4	(36) 16d	(12) 16d	3310	7675	3310	6900
									14.74	34.19	14.74	30.73
SS	LU210L	20	1 1/8	8	1 1/4	7 1/4	(10) 10d	(6) 10d x 1 1/2"	1140	2495	1020	1770
									5.07	11.10	4.54	7.87
SS	LUS210	18	1 1/8	7 1/4	1 3/4	3 3/4	(8) 10d	(4) 10d	1420	2785	1290	2210
									6.32	12.39	5.74	9.83


1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_e is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSON and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _a ¹	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
								lb.	lb.	lb.	lb.
								kN	kN	kN	kN
Double 2x Sizes											
■ LUS24-2	18	3 1/4	3 1/4	2	1 1/2	(4) 16d	(2) 16d	835	2020	590	1435
SS LUS26-2	18	3 1/4	4 1/4	2	4	(4) 16d	(4) 16d	3.71	8.89	2.62	6.38
■ HHUS26-2	14	3 1/4	5 1/4	3	3 1/4	(14) 16d	(6) 16d	1720	2595	1545	1920
■ HGUS26-2	12	3 1/4	5 1/4	4	4 1/4	(20) 16d	(8) 16d	7.65	11.54	6.87	8.54
SS LUS28-2	18	3 1/4	7	2	4	(8) 16d	(4) 16d	2850	7335	2065	5205
■ HHUS28-2	14	3 1/4	7 1/4	3	6 1/4	(22) 16d	(8) 16d	12.68	32.83	9.20	23.15
■ HGUS28-2	12	3 1/4	7 1/4	4	6 1/4	(36) 16d	(12) 16d	4385	8950	3110	6355
SS LUS210-2	18	3 1/4	9	2	6	(8) 16d	(8) 16d	19.51	39.81	13.83	28.27
■ HHUS210-2	14	3 1/4	9 1/4	3	8	(30) 16d	(10) 16d	7.85	14.79	6.87	11.45
■ HGUS210-2	12	3 1/4	9 1/4	4	8 1/4	(46) 16d	(16) 16d	3765	8940	2675	6345
								16.75	39.77	11.90	28.22
								6070	12980	4310	9215
								27.00	57.74	19.17	40.99
SS LUS210-2	18	3 1/4	9	2	6	(8) 16d	(8) 16d	2580	4500	2320	3195
■ HHUS210-2	14	3 1/4	9 1/4	3	8	(30) 16d	(10) 16d	11.48	20.02	10.32	14.21
■ HGUS210-2	12	3 1/4	9 1/4	4	8 1/4	(46) 16d	(16) 16d	4670	9660	4235	7000
								20.77	42.97	18.84	31.14
								6840	14015	4855	10270
								30.43	62.34	21.60	45.69
Triple 2x Sizes											
■ HGUS26-3	12	4 1/4	5 1/4	4	4 1/4	(20) 16d	(8) 16d	4385	8950	3110	6355
■ HGUS28-3	12	4 1/4	7 1/4	4	6 1/4	(36) 16d	(12) 16d	19.51	39.81	13.83	28.27
■ HHUS210-3	14	4 1/4	9	3	7 1/4	(30) 16d	(10) 16d	6070	12980	4310	9215
■ HGUS210-3	12	4 1/4	9 1/4	4	8 1/4	(46) 16d	(16) 16d	27.00	57.74	19.17	40.99
								4670	9670	4235	6965
								20.77	43.02	18.84	30.54
								6840	14645	4855	10400
								30.43	65.14	21.60	46.28
Quadruple 2x Sizes											
■ HGUS28-4	12	6 1/4	5 1/4	4	4 1/4	(20) 16d	(8) 16d	4385	8950	3110	6355
■ HGUS28-4	12	6 1/4	7 1/4	4	6 1/4	(36) 16d	(12) 16d	19.51	39.81	13.83	28.27
■ HHUS210-4	14	6 1/4	8 1/4	3	7 1/4	(30) 16d	(10) 16d	6070	12980	4310	9215
■ HGUS210-4	12	6 1/4	9 1/4	4	8 1/4	(46) 16d	(16) 16d	27.00	57.74	19.17	40.99
								4670	10155	4235	7210
								20.77	45.17	18.84	32.07
								6840	14645	4855	10400
								30.43	65.14	21.60	46.28
■ HGUS212-4	12	6 1/4	10 1/4	4	10 1/4	(56) 16d	(20) 16d	7640	14995	5425	10645
■ HGUS214-4	12	6 1/4	12 1/4	4	11 1/4	(66) 16d	(22) 16d	33.98	66.70	24.13	47.35
								10130	16400	7195	11645
								45.06	72.95	32.00	51.80
4x Sizes											
■ LUS46	18	3 1/4	4 1/4	2	3 1/4	(4) 16d	(4) 16d	1720	2595	1545	1920
■ HHUS46	14	3 1/4	5 1/4	3	3 1/4	(14) 16d	(6) 16d	7.65	11.54	6.87	8.54
■ HGUS46	12	3 1/4	5 1/4	4	4 1/4	(20) 16d	(8) 16d	2540	7335	2065	5205
■ LUS48	18	3 1/4	6 1/4	2	3 1/4	(6) 16d	(4) 16d	11.30	32.83	9.20	23.15
■ HHUS48	14	3 1/4	7 1/4	3	6 1/4	(22) 16d	(8) 16d	4385	8950	3110	6355
■ HGUS48	12	3 1/4	7 1/4	4	6 1/4	(36) 16d	(12) 16d	19.51	39.81	13.83	28.27
■ LUS410	18	3 1/4	8 1/4	2	5 1/4	(8) 16d	(8) 16d	1720	3325	1545	2575
■ HHUS410	14	3 1/4	9 1/4	3	8 1/4	(30) 16d	(10) 16d	7.85	14.79	6.87	11.45
■ HGUS410	12	3 1/4	9 1/4	4	8 1/4	(46) 16d	(16) 16d	3765	8940	2675	6345
								16.75	39.77	11.90	28.22
								6070	12980	4310	9215
								27.00	57.74	19.17	40.99
■ LUS412	18	3 1/4	10 1/4	2	6 1/4	(16) 16d	(16) 16d	2580	4500	2320	3195
■ HGUS412	12	3 1/4	10 1/4	4	10 1/4	(56) 16d	(20) 16d	11.48	20.02	10.32	14.21
■ HGUS414	12	3 1/4	12 1/4	4	11 1/4	(66) 16d	(22) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
								7640	14995	5425	10645
								33.98	66.70	24.13	47.35
								10130	16400	7195	11645
								45.06	72.95	32.00	51.80



Plated Truss Connectors

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1¼". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1½" = 0.148" dia. x 1½" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

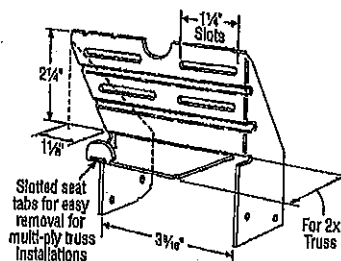


TC24
U.S. Patent 4,832,173

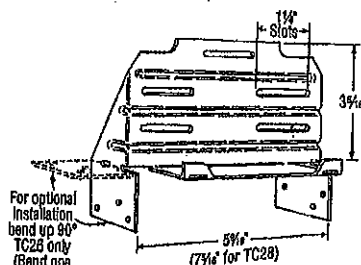


TC26
(TC28 Similar)

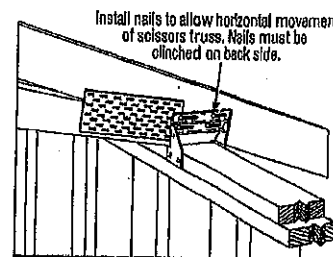

Typical TC24 Installation

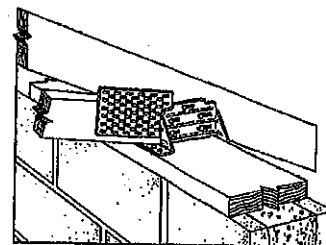

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer (8", 10", 12" Wall Installation Similar)

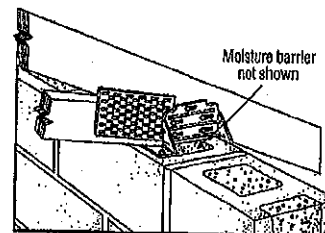

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _o =1.15)	Uplift (K _o =1.15)
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _o =1.15)	Uplift (K _o =1.15)
TC26	(5) 10d	(6) 10d x 1½"	810	660
	(5) 10d	(6) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.

2. Grout strength is 15 MPa minimum.

3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.

4. TC26 fastened to grouted concrete block with (8) - ¾" x 2½" Titen screws has a factored uplift resistance of 275 lb.



UNITED STATES DESIGN

(800) 999-5099
strongtie.com

H/TSP

SIMPSON
Strong-Tie

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance (K _p = 1.15)					
		To Rafter/Truss	To Plates	To Studs	D.Fir-L			S-P-F		
					Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(6) 8d x 1½"	(4) 8d	—	740	685	300	680	485	215
					3.29	3.05	1.33	3.02	2.16	0.96
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
					3.58	0.71	0.71	3.38	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	285	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ³	18	(6) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A ⁹	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	565	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.64	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^{7,8}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1485	795	315	1040	565	225
					6.62	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
		[2] (12) 8d x 1½"	(15) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
TSP	18	(9) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
					5.76	1.96	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.96	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 695 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 8/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.162" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to **wind** the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

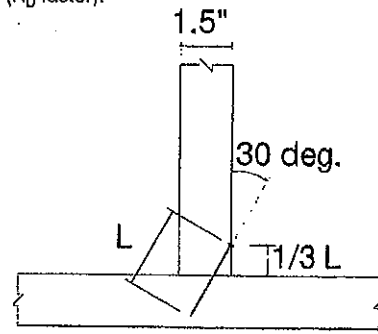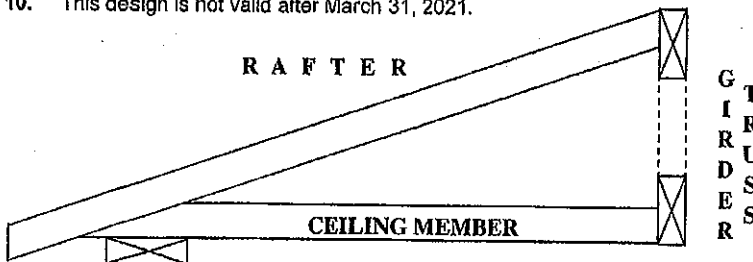


TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019

PEO
Certificate No. 10689485



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

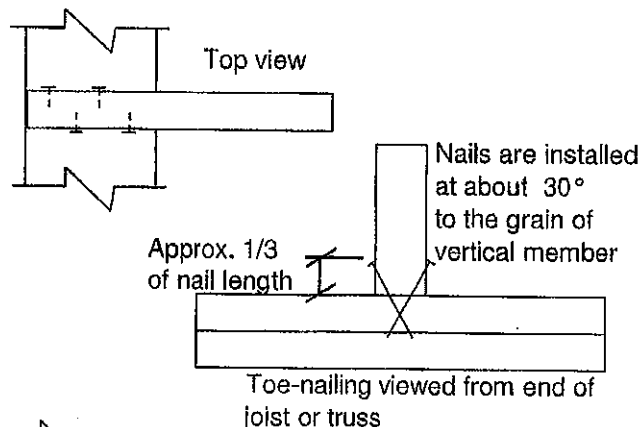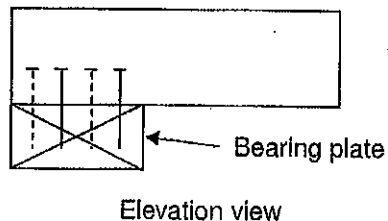

Toe-nailing on 2x4 Bearing Plate

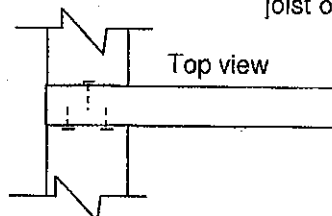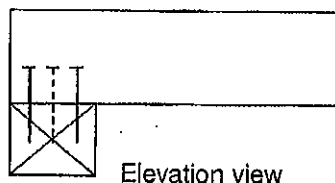

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7


PEO
Certificate No. 10889485




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint, unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/8" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

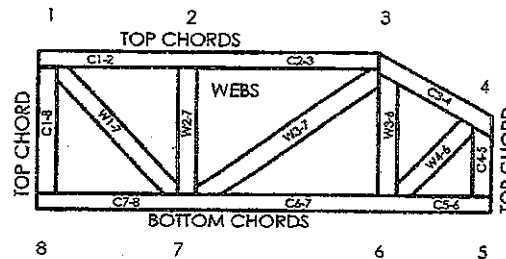

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L 10319-L 13270-L 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MII-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane of joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

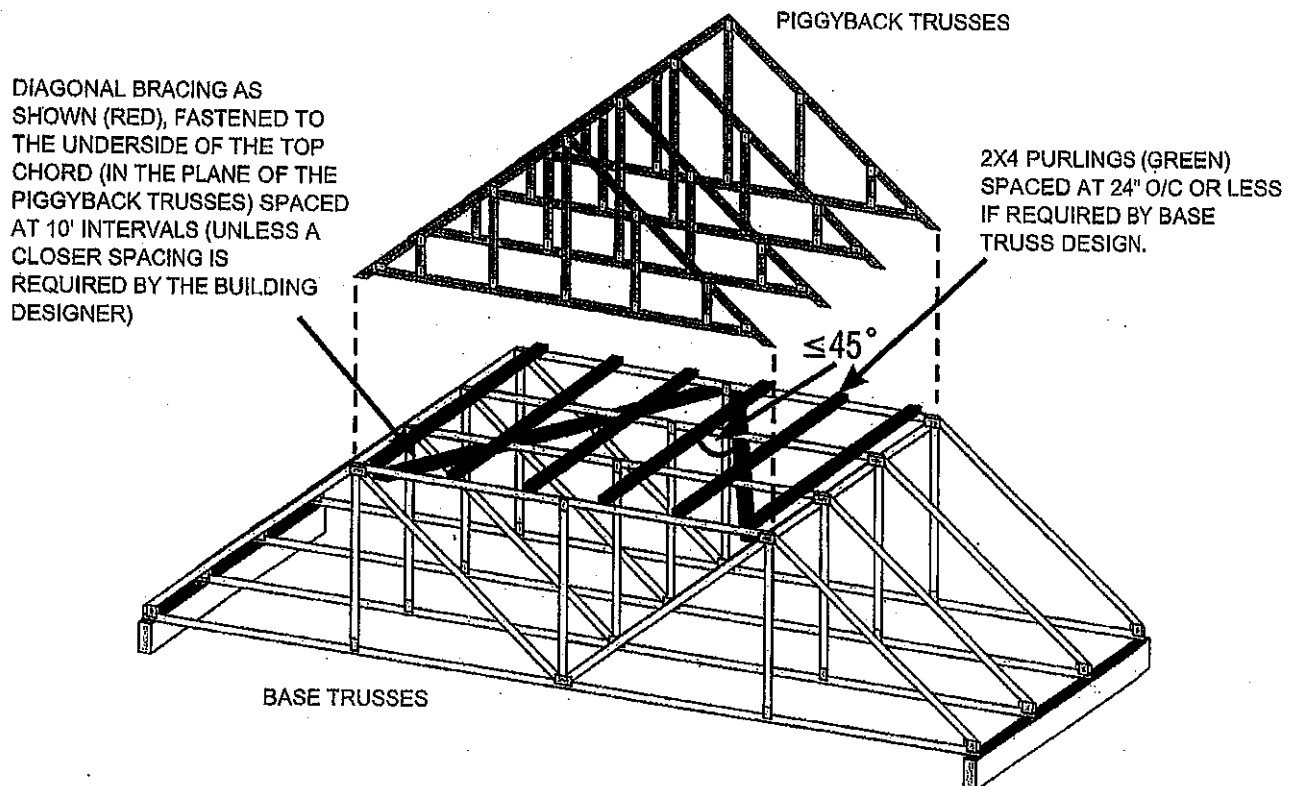

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1800218

Feb 09, 2018