

8/12 roof pitch unless noted

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.


All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.


DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
LUS26-2-(VV)

BEAMS:
B20= B21 =
2 - 2x10 SPF #2

 DENOTES: CONVENTIONAL FRAMING

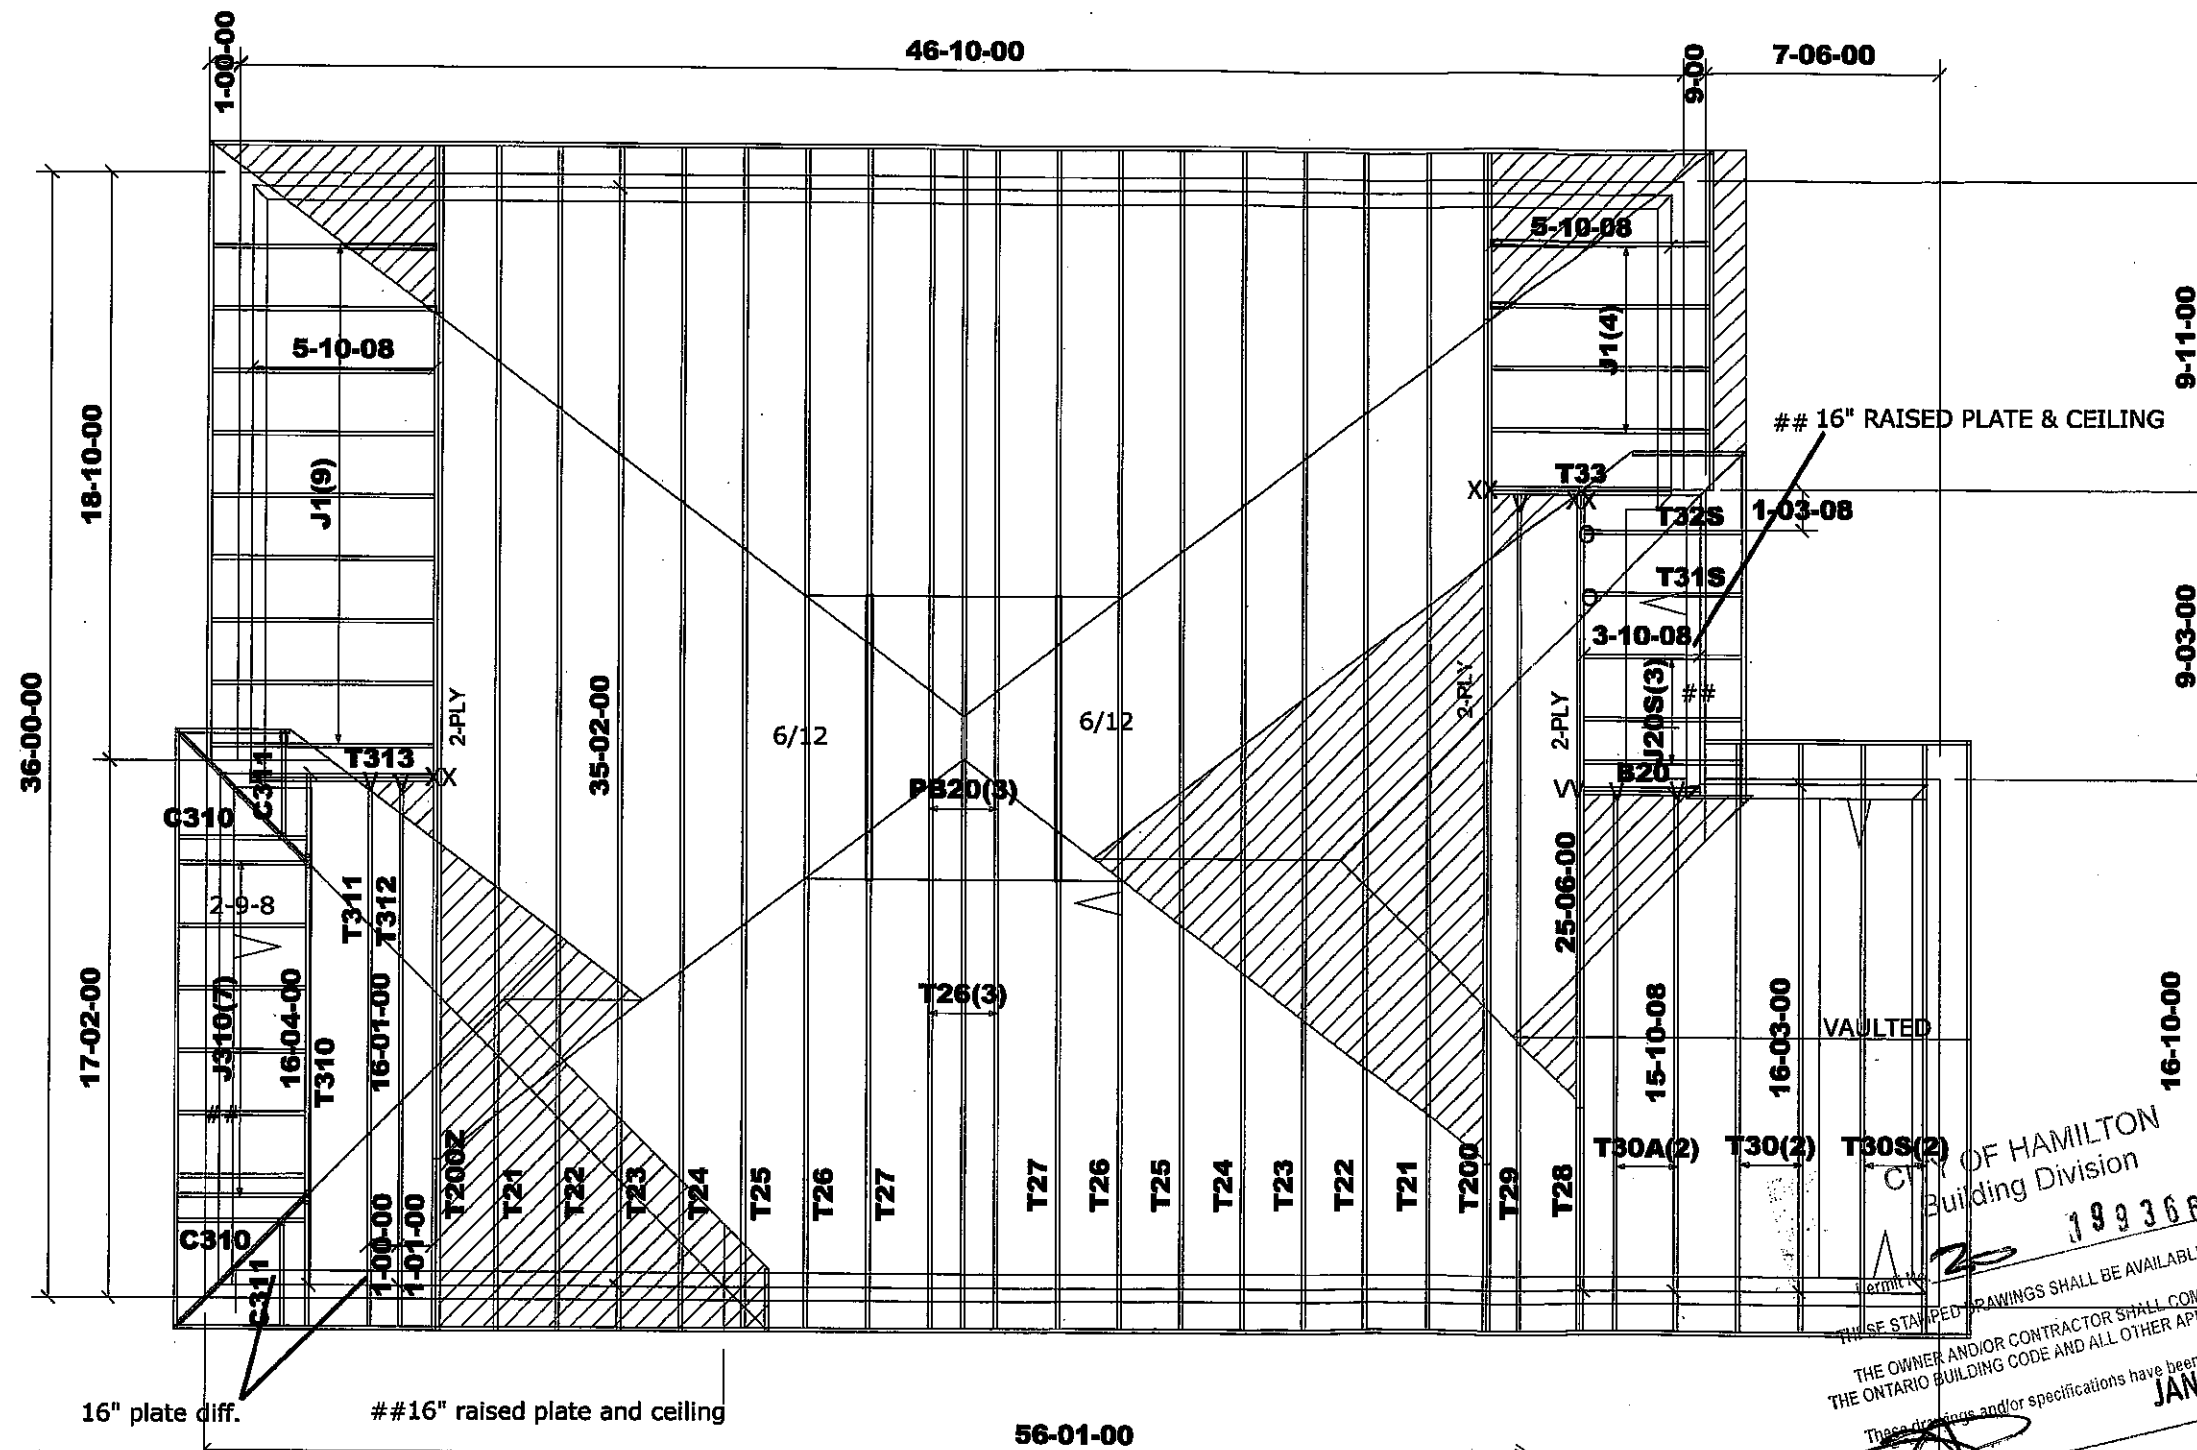



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 5-019
 Lot #:
 Elevation: 2- OPT.5BRM

Job Track: 51225
 PlanLog: 202406
 Layout ID: 412083
 Ref #
 Page: 1 of 3
 Date: 08-25-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T21 Hip	8 /12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	279.76 177.00		
	2	T22 Hip	8 /12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	302.77 191.33		
	2	T23 Hip	8 /12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	309.14 195.67		
	2	T24 Hip	8 /12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	316.79 196.67		
	2	T25 Hip	8 /12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	329.26 205.00		
	5	T26 Hip	8 /12	35-02-00	10-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	857.95 538.33		
	2	T27 Hip	8 /12	35-02-00	11-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	332.54 206.67		
	1 2-ply	T28 Hip Girder	8 /12	25-06-00	5-03-13	2 x 4 2 x 6	1-03-08	1-04-13 2-08-13	244.99 150.00		
	1	T29 Hip	8 /12	25-06-00	6-07-13	2 x 4	1-03-08	1-04-13 2-08-13	108.69 70.33		
	2	T30 Common	8 /12	16-03-00	6-09-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	144.92 91.33		
	2	T30A Common	8 /12	15-10-08	6-09-13	2 x 4	1-03-08	1-04-13 1-04-13	139.63 87.67		
	2	T30S Scissor	8 /12 4 /12	16-03-00	6-09-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	133.1 87.33		
	1	T31S Half Hip	8 /12	3-10-08	4-09-13	2 x 4	1-03-08	1-04-13 4-09-13	29.4 20.17		
	1	T32S Half Hip	8 /12	3-10-08	3-05-13	2 x 4	1-03-08	1-04-13 3-05-13	24.66 17.17		



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 5-019
 Lot #:
 Elevation: 2- OPT.5BRM

Job Track: 51225
 PlanLog: 202406
 Layout ID: 412083
 Ref #
 Page: 2 of 3
 Date: 08-25-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T33 Jack-Closed Girder	6 /12	5-10-08	4-01-04	2 x 4 2 x 6		1-02-00 4-01-04	57.64 37.00		
	1 2-ply	T200 Hip Girder	8 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	357.58 220.67		
	1 2-ply	T200Z Hip Girder	8 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	357.58 220.67		
	1	T310 Hip Girder	8 /12	16-04-00	3-03-02	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	64.93 41.50		
	1	T311 Hip	8 /12	16-01-00	5-11-02	2 x 4	1-03-08	2-08-13 2-10-13	73.38 47.83		
	1	T312 Hip	8 /12	16-01-00	6-05-02	2 x 4	1-03-08 1-03-08	2-06-13 2-08-13	73.21 46.67		
	1 2-ply	T313 Flat Girder	0 /12	5-10-08	1-04-00	2 x 6		1-04-00 1-04-00	53.6 35.00		
	3	PB20 Piggyback	8 /12	9-00-12	2-00-00	2 x 4			74.64 50.50		
	13	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	218.33 138.67		
	3	J20S Jack-Open	8 /12	3-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	85.86 57.50		
	7	J310 Jack-Open	8 /12	2-09-08	3-03-02	2 x 4	1-03-08	1-04-13 3-03-02	82.84 57.17		
	2	C310 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 10-09	1-04-13 2-08-02	20.42 14.00		
	2	C311 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 1-01	1-04-13 2-08-02	18.61 12.67		

TOTAL # TRUSS= 69

TOTAL BFT OF ALL TRUSSES= 3214.52

BFT.

TOTAL WEIGHT OF ALL TRSSES 5092.09 LBS



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
Builder: GREEN PARK HOMES
Project: RUSSELL GARDENS PH.3
Location: WATERDOWN
Model: MOUNTAINASH 5-019
Lot #:
Elevation: 2- OPT.5BRM

Job Track: 51225
PlanLog: 202406
Layout ID: 412083
Ref #
Page: 3 of 3
Date: 08-25-2020
Designer:
Sales Rep: Mario DiCano

HARDWARE

QTY	TYPE	MODEL	LENGTH
3	Hardware	HGUS26-2	
5	Hardware	LJS26DS	
2	Hardware	LUS24	
1	Hardware	LUS26-2	


TOTAL NUMBER OF ITEMS= 11

JOB NAME 408168	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	-------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:48 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns1I-Mcniq2FIKqQuZwGH_JYq9JSI_3jk34wGOWeSzNBRL

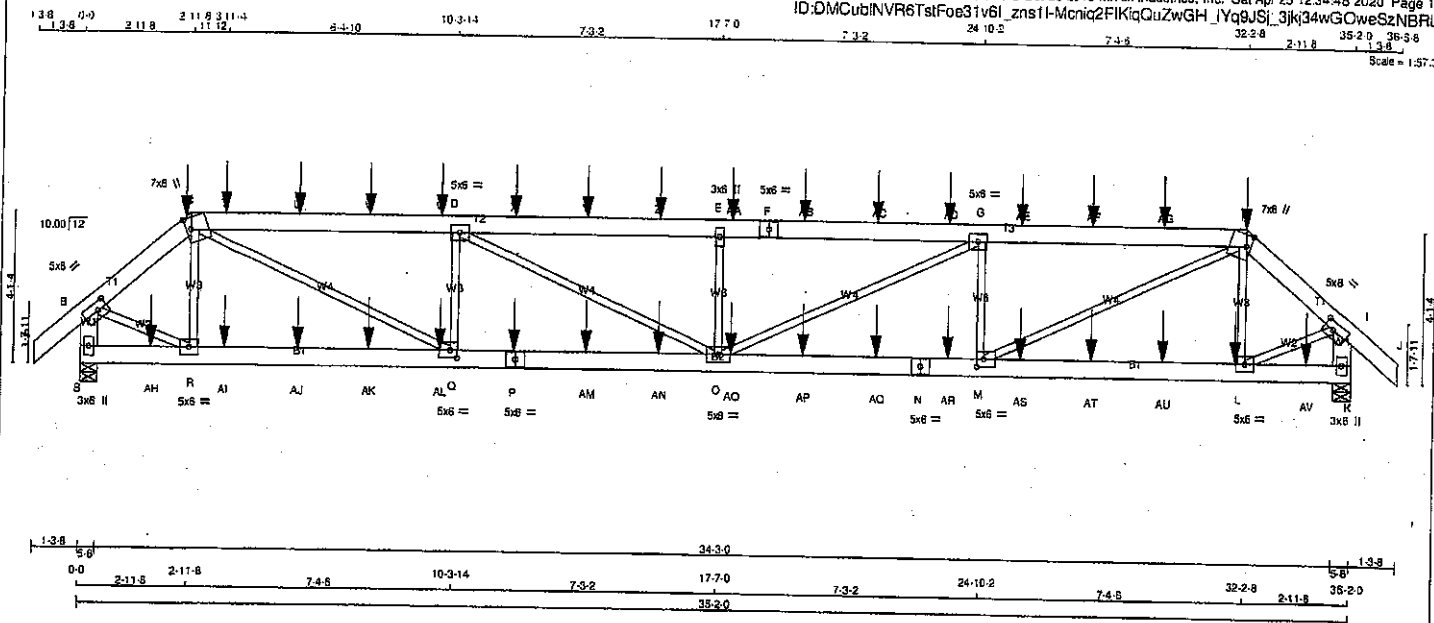

LUMBER	SIZE	DRY	LUMBER	DESCR.
A - C	2x6	DRY	No.2	SPF
C - F	2x6	DRY	No.2	SPF
F - H	2x6	DRY	No.2	SPF
H - J	2x6	DRY	No.2	SPF
S - B	2x6	DRY	No.2	SPF
K - I	2x6	DRY	No.2	SPF
S - P	2x6	DRY	2100F 1.8E	SPF
P - N	2x6	DRY	2100F 1.8E	SPF
N - K	2x6	DRY	2100F 1.8E	SPF

ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS	#ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS			
A-C	2	12	SIDE(122.0)
C-F	2	12	SIDE(81.0)
F-H	2	12	SIDE(81.0)
H-J	2	12	SIDE(122.0)
S-B	2	12	TOP
K-I	2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS			
S-P	2	12	SIDE(0.0)
P-N	2	12	SIDE(0.0)
N-K	2	12	SIDE(197.8)
WEBS : (0.122"x3") SPIRAL NAILS			
2x3	1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
S	3330	0	0	3330	0	0	0	5-8	5-8
K	3379	0	0	3379	0	0	0	5-8	5-8

UNFACTORED REACTIONS							
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	2354	1553 / 0	0 / 0	0 / 0	0 / 0	801 / 0	0 / 0
K	2388	1572 / 0	0 / 0	0 / 0	0 / 0	816 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.98 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LG1 MAX (PLF)	MAX. CSI (LC)	MAX. UNBRACED LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 / 42	-91.8	-91.8	0.04 (1)	10.00	R-C	-650 / 0 0.08 (1)
B-C	-3387 / 0	-91.8	-91.8	0.05 (1)	8.02	C-Q	0 / 4509 0.58 (1)
C-T	-6802 / 0	-91.8	-91.8	0.38 (1)	4.31	Q-D	-1799 / 0 0.22 (1)
T-U	-6602 / 0	-91.8	-91.8	0.38 (1)	4.31	D-O	0 / 1370 0.17 (1)
U-V	-8602 / 0	-91.8	-91.8	0.38 (1)	4.31	O-E	-987 / 0 0.12 (1)
V-W	-6602 / 0	-91.8	-91.8	0.38 (1)	4.31	E-G	0 / 1362 0.17 (1)
W-D	-6602 / 0	-91.8	-91.8	0.38 (1)	4.31	G-H	-1787 / 0 0.21 (1)
D-X	-7826 / 0	-91.8	-91.8	0.42 (1)	3.98	H-H	0 / 4461 0.56 (1)
X-Y	-7826 / 0	-91.8	-91.8	0.42 (1)	3.98	L-H	-861 / 0 0.08 (1)
Y-Z	-7826 / 0	-91.8	-91.8	0.42 (1)	3.98	B-R	0 / 2738 0.34 (1)
Z-E	-7826 / 0	-91.8	-91.8	0.42 (1)	3.98	L-I	0 / 2771 0.34 (1)
E-AA	-7826 / 0	-91.8	-91.8	0.42 (1)	3.98		
AA-F	-7826 / 0	-91.8	-91.8	0.42 (1)	3.98		
F-AB	-7826 / 0	-91.8	-91.8	0.42 (1)	3.98		
AB-AC	-7826 / 0	-91.8	-91.8	0.42 (1)	3.98		
AC-AD	-7826 / 0	-91.8	-91.8	0.42 (1)	3.98		
AD-G	-7826 / 0	-91.8	-91.8	0.42 (1)	3.98		
G-AE	-6608 / 0	-91.8	-91.8	0.38 (1)	4.31		
AE-AF	-6608 / 0	-91.8	-91.8	0.38 (1)	4.31		
AF-AG	-6608 / 0	-91.8	-91.8	0.38 (1)	4.31		
AG-H	-6608 / 0	-91.8	-91.8	0.38 (1)	4.31		
H-I	-3410 / 0	-91.8	-91.8	0.05 (1)	6.00		
I-J	0 / 42	-91.8	-91.8	0.04 (1)	10.00		
S-B	-3375 / 0	0.0	0.0	0.12 (1)	7.58		
K-I	-3414 / 0	0.0	0.0	0.12 (1)	7.55		

S-AH	0 / 0	-18.5	-18.5	0.05 (4)	10.00
AH-R	0 / 0	-18.5	-18.5	0.05 (4)	10.00
R-AI	0 / 2553	-18.5	-18.5	0.12 (1)	10.00
AI-AJ	0 / 2553	-18.5	-18.5	0.12 (1)	10.00
AJ-AK	0 / 2553	-18.5	-18.5	0.12 (1)	10.00
AK-AL	0 / 2553	-18.5	-18.5	0.12 (1)	10.00
AL-O	0 / 2553	-18.5	-18.5	0.12 (1)	10.00
O-P	0 / 8602	-18.5	-18.5	0.22 (1)	10.00
P-AM	0 / 8602	-18.5	-18.5	0.22 (1)	10.00
AM-AN	0 / 8602	-18.5	-18.5	0.22 (1)	10.00
AN-O	0 / 8602	-18.5	-18.5	0.22 (1)	10.00
O-AO	0 / 8602	-18.5	-18.5	0.22 (1)	10.00
AO-AP	0 / 8602	-18.5	-18.5	0.22 (1)	10.00
AP-AQ	0 / 8602	-18.5	-18.5	0.22 (1)	10.00
AQ-N	0 / 8602	-18.5	-18.5	0.22 (1)	10.00
N-AR	0 / 8602	-18.5	-18.5	0.22 (1)	10.00
AR-M	0 / 8602	-18.5	-18.5	0.22 (1)	10.00

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL	= 25.8 PSF
DL	= 6.0 PSF
BOY CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = L/999 (0.20")
ALLOWABLE DEFL.(TL) = L/360 (1.17)
CALCULATED VERT. DEFL.(TL) = L/999 (0.37")

CSI: TC=0.42/1.00 (D-E:1), BC=0.22/1.00 (O-Q:1), WB=0.56/1.00 (C-Q:1), SSI=0.22/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (H) INPUT = 0.90
JSI METAL= 0.65 (N) INPUT = 1.00




Structural component only
DWG# T-2007129 1/2

PLATES (table is in inches)						LOADING									
JT	TYPE	PLATES	W	LEN	Y	X	TOTAL LOAD CASES: (4)								
B	TMWW-I	MT20	5.0	8.0	2.50	3.25	CHORDS								
C	TTWW-m	MT20	7.0	8.0	3.75	1.50	MEMB. MAX. FACTORED FORCE (LBS)								
D	TMWW-I	MT20	5.0	6.0			FACTORED VERT. LOAD LC1 MAX (PLF)								
E	TMWW-w	MT20	3.0	6.0			CS1(LC) UNBRAC								
F	TS-I	MT20	5.0	6.0			MEMB. MAX. FACTORED FORCE (LBS)								
G	TMWW-I	MT20	5.0	6.0			CS1(LC)								
H	TTWW-m	MT20	7.0	8.0	3.75	1.50	WEBS								
I	TMWW-I	MT20	5.0	8.0	2.50	3.25	MEMB. MAX. FACTORED FORCE (LBS)								
K	BMV1+p	MT20	3.0	6.0			CS1(LC)								
L	BMWW-I	MT20	5.0	6.0			LENGTH FR-TO								
M	BMWW-I	MT20	5.0	6.0	2.50	2.25	FR-TO								
N	BS-I	MT20	5.0	6.0			M-AS								
O	BMWW-I	MT20	5.0	6.0			AS-AT								
P	BS-I	MT20	5.0	6.0			AT-AU								
Q	BMWW-I	MT20	5.0	6.0	2.50	2.25	AU-L								
R	BMWW-I	MT20	5.0	6.0			L-AV								
S	BMV1+p	MT20	3.0	6.0			AV-K								

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-11-8	-38	-42	---	FRONT	VERT	DEAD	---	C1
C	2-11-8	-191	-191	---	FRONT	VERT	SNOW	---	C1
H	32-2-8	-38	-42	---	FRONT	VERT	DEAD	---	C1
H	32-2-8	-116	-116	---	FRONT	VERT	TOTAL	---	C1
H	32-2-8	-191	-191	---	FRONT	VERT	SNOW	---	C1
L	31-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
P	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	3-11-4	-111	-111	---	FRONT	VERT	TOTAL	---	C1
U	5-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	17-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	19-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	21-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	23-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	25-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	27-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AG	29-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AH	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AL	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AM	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AN	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	17-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AP	19-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AQ	21-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AR	23-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AS	25-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AT	27-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AU	29-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AV	33-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

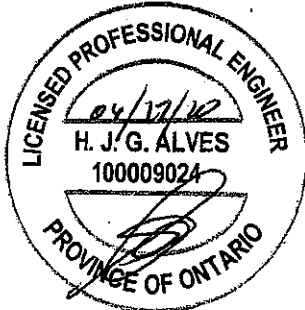

JOB NAME 408168	TRUSS NAME T1Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitex Industries, Inc. Sat Apr 25 12:34:49 2020 Page 1
 ID:DMCubINVR6TstFoe31v6L_zns1l-qoL41NGW50yHWVSRpnNNRbzOlzT4?D9w8UBuzNBRK
 Scale = 1:57.2

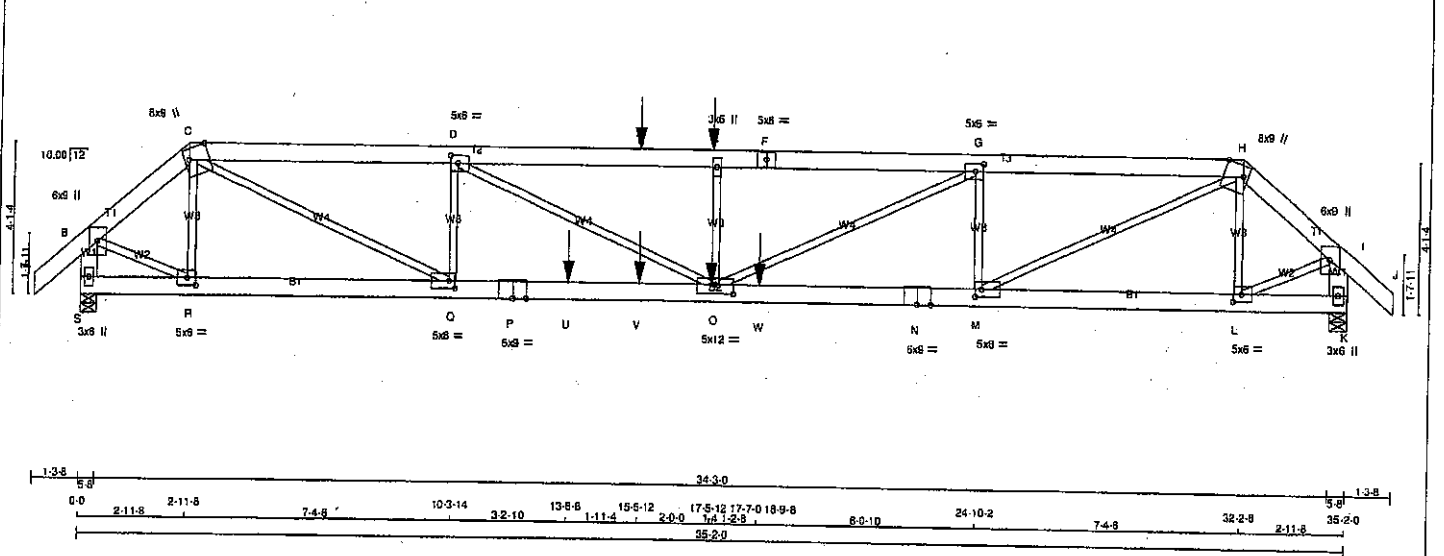

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x6 DRY	No.2	SPF
C - F	2x6 DRY	No.2	SPF
F - H	2x6 DRY	No.2	SPF
H - J	2x6 DRY	No.2	SPF
S - B	2x6 DRY	No.2	SPF
K - I	2x6 DRY	No.2	SPF
S - P	2x6 DRY	2100F 1.8E	SPF
P - N	2x6 DRY	2100F 1.8E	SPF
N - K	2x6 DRY	2100F 1.8E	SPF

ALL WEBS 2x3 DRY No.2 SPF
 EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C 2	12	TOP SIDE(183.1)
C-F 2	12	TOP
F-H 2	12	TOP
H-J 2	12	TOP
S-B 2	12	TOP
K-I 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S-P 2	12	TOP
P-N 2	12	SIDE(197.8)
N-K 2	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT VERT 3963 0	DOWN 3963 0	IN-SX 5-8	IN-SX 5-8
K HORIZ 3687 0	UPLIFT 3687 0	IN-SX 5-8	IN-SX 5-8

UNFACTORED REACTIONS			
1ST LCASE	MAX./MIN. COMPONENT REACTIONS		
JT COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL		
S 2793	1890 / 0 0 / 0 0 / 0 0 / 0 902 / 0 0 / 0		
K 2599	1758 / 0 0 / 0 0 / 0 0 / 0 843 / 0 0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.20 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MAX. FACTORED		FACTORED		MAX. FACTORED		
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO		LENGTH FR-TO		
A-B	0 / 42	-91.8 -91.8 0.04 (1)	10.00	R-C	-1086 / 0	0.13 (1)
B-C	-3986 / 0	-91.8 -91.8 0.06 (1)	5.65	C-Q	0 / 7263	0.80 (1)
C-D	-9534 / 0	-91.8 -91.8 0.37 (1)	3.74	Q-D	-2160 / 0	0.28 (1)
D-E	-12331 / 0	-91.8 -91.8 0.52 (1)	3.20	D-O	0 / 3130	0.39 (1)
E-F	-12331 / 0	-91.8 -91.8 0.52 (1)	3.20	O-E	-776 / 0	0.09 (1)
F-G	-12331 / 0	-91.8 -91.8 0.50 (1)	3.23	G-G	0 / 4203	0.52 (1)
G-H	-8675 / 0	-91.8 -91.8 0.50 (1)	3.23	M-H	0 / 6383	0.79 (1)
H-I	-3758 / 0	-91.8 -91.8 0.33 (1)	3.94	L-H	-843 / 0	0.10 (1)
I-J	0 / 42	-91.8 -91.8 0.04 (1)	10.00	B-R	0 / 3239	0.40 (1)
J-K	-3945 / 0	0.0 0.0 0.14 (1)	7.14	L-I	0 / 3052	0.38 (1)
K-L	-3733 / 0	0.0 0.0 0.13 (1)	7.29			
A-R	0 / 0	-18.5 -18.5 0.02 (4)	10.00			
B-Q	0 / 3013	-18.5 -18.5 0.21 (1)	10.00			
C-P	0 / 9534	-18.5 -18.5 0.67 (1)	10.00			
D-U	0 / 9534	-18.5 -18.5 0.67 (1)	10.00			
E-V	0 / 9534	-18.5 -18.5 0.67 (1)	10.00			
F-O	0 / 9534	-18.5 -18.5 0.67 (1)	10.00			
G-W	0 / 8575	-18.5 -18.5 0.49 (1)	10.00			
H-N	0 / 8575	-18.5 -18.5 0.49 (1)	10.00			
I-M	0 / 8575	-18.5 -18.5 0.49 (1)	10.00			
J-L	0 / 2844	-18.5 -18.5 0.12 (1)	10.00			
K-K	0 / 0	-18.5 -18.5 0.05 (1)	10.00			


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T1Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:49 2020 Page 2
ID:DMCubINVR6TstFoe31v6l_zns1l-qcL41NGw50yfWfVSqpnNNrbzOizT4?D9w8UBuzNBRK


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	6.0	9.0		
C	TTWW+m	MT20	8.0	9.0	Edge	6.50
D	TMWW-t	MT20	5.0	6.0	2.50	2.50
E	TMW+w	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMWW-t	MT20	5.0	6.0	2.50	2.50
H	TTWW+m	MT20	8.0	9.0	Edge	6.50
I	TMVW+p	MT20	6.0	9.0		
K	BMV1+p	MT20	3.0	6.0		
L	BMWW-t	MT20	6.0	6.0	2.50	2.75
M	BMWW-t	MT20	5.0	8.0	2.50	2.00
N	BS-t	MT20	6.0	9.0		
O	BMWWW-t	MT20	5.0	12.0	3.00	6.00
P	BS-t	MT20	6.0	9.0		
Q	BMWW-t	MT20	5.0	8.0	2.50	2.00
R	BMWW-t	MT20	5.0	6.0	2.50	2.75
S	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

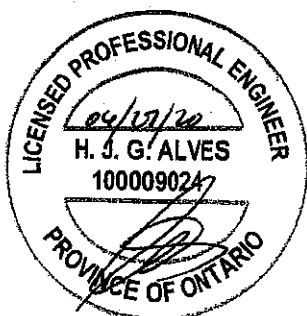

Structural component only
DWG# T-2007130 42

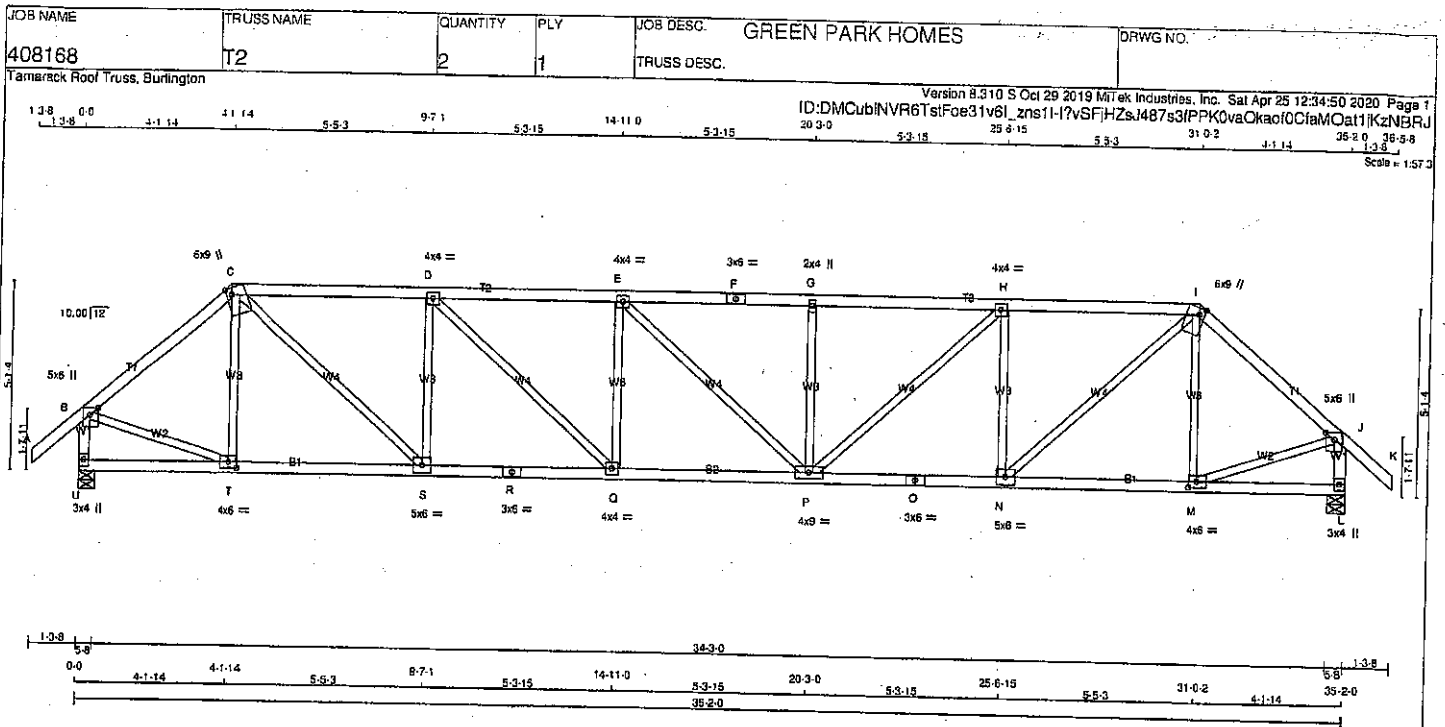

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
A - C	2x4	DRY No.2
C - F	2x4	DRY No.2
F - I	2x4	DRY No.2
I - K	2x4	DRY No.2
U - B	2x4	DRY No.2
L - J	2x4	DRY No.2
U - R	2x4	DRY No.2
R - O	2x4	DRY No.2
O - L	2x4	DRY No.2

ALL WEBS EXCEPT
SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	V	X
B TMWV+p	MT20	5.0	6.0	Edge	2.75
C TTWV+m	MT20	6.0	9.0	Edge	1.75
D, E, H					
D TMWV-t	MT20	4.0	4.0		
F TS-t	MT20	3.0	6.0		
G TMWV+w	MT20	2.0	4.0		
J TTWV+m	MT20	6.0	9.0	Edge	1.75
J TMWV+p	MT20	5.0	6.0	Edge	2.75
L BMV1+p	MT20	3.0	4.0		
M BMWV-t	MT20	4.0	6.0	2.00	2.75
N BMWV-t	MT20	5.0	6.0		
O BS-t	MT20	3.0	6.0		
P BMWV-t	MT20	4.0	9.0		
Q BMWV-t	MT20	4.0	4.0		
R BS-t	MT20	3.0	6.0		
S BMWV-t	MT20	5.0	6.0		
T BMWV-t	MT20	4.0	6.0	2.00	2.75
U BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
U	2066	0	2066	0	5-8	5-8
L	2066	0	2066	0	5-8	5-8

UNFACTORED REACTIONS

JT	MAX./MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
U	1456	971 / 0	0 / 0	0 / 0	0 / 0	489 / 0	0 / 0
L	1456	971 / 0	0 / 0	0 / 0	0 / 0	489 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (L)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (L)	MEMB.
FR-TO				FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	T-C	-358 / 0	0.14 (1)
B-C	-1960 / 0	-91.8	-91.8 0.36 (1)	4.46	C-S	0 / 1836	0.41 (1)
C-D	-2871 / 0	-91.8	-91.8 0.57 (1)	3.59	S-D	-1118 / 0	0.43 (1)
D-E	-3506 / 0	-91.8	-91.8 0.65 (1)	3.21	D-Q	0 / 856	0.19 (1)
E-F	-3505 / 0	-91.8	-91.8 0.53 (1)	3.36	Q-E	-475 / 0	0.18 (1)
F-G	-3505 / 0	-91.8	-91.8 0.53 (1)	3.36	E-P	-2 / 0	0.00 (1)
G-H	-3505 / 0	-91.8	-91.8 0.66 (1)	3.20	P-G	-474 / 0	0.19 (1)
H-I	-2871 / 0	-91.8	-91.8 0.57 (1)	3.59	P-H	0 / 853	0.18 (1)
I-J	-1960 / 0	-91.8	-91.8 0.36 (1)	4.46	H-N	-1117 / 0	0.43 (1)
J-K	0 / 41	-91.8	-91.8 0.13 (1)	10.00	N-I	0 / 1837	0.41 (1)
U-B	-2037 / 0	0.0	0.0 0.22 (1)	5.92	M-I	-358 / 0	0.14 (1)
L-J	-2037 / 0	0.0	0.0 0.22 (1)	5.92	B-T	0 / 1571	0.35 (1)
U-T	0 / 0	-18.5	-18.5 0.10 (4)	10.00	M-J	0 / 1571	0.35 (1)
T-S	0 / 1494	-18.5	-18.5 0.30 (1)	10.00			
S-R	0 / 2871	-18.5	-18.5 0.51 (1)	10.00			
R-Q	0 / 2871	-18.5	-18.5 0.51 (1)	10.00			
Q-P	0 / 3506	-18.5	-18.5 0.62 (1)	10.00			
P-O	0 / 2872	-18.5	-18.5 0.51 (1)	10.00			
O-N	0 / 2872	-18.5	-18.5 0.51 (1)	10.00			
N-M	0 / 1494	-18.5	-18.5 0.30 (1)	10.00			
M-L	0 / 0	-18.5	-18.5 0.10 (4)	10.00			

TOTAL WEIGHT = 2 X 147 = 293 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = U/999 (0.20")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = U/999 (0.39")

CSI: TC=0.66/1.00 (G-H:1), BC=0.52/1.00 (P-Q:1), WB=0.43/1.00 (D-S:1), SS=0.23/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (N) (INPUT = 0.90)
JSI METAL = 0.90 (O) (INPUT = 1.00)



Structural component only
DWG# T-2007131

JOB NAME 408168	TRUSS NAME T3	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:51 2020 Page 1	
ID:DMCubINVR6TstFoe31v6l_zns1l-mBTs3IBddC7I0en7rFS0xtJC1Ex4wWcEdaFnzNBRI				Scale = 1:57.4	

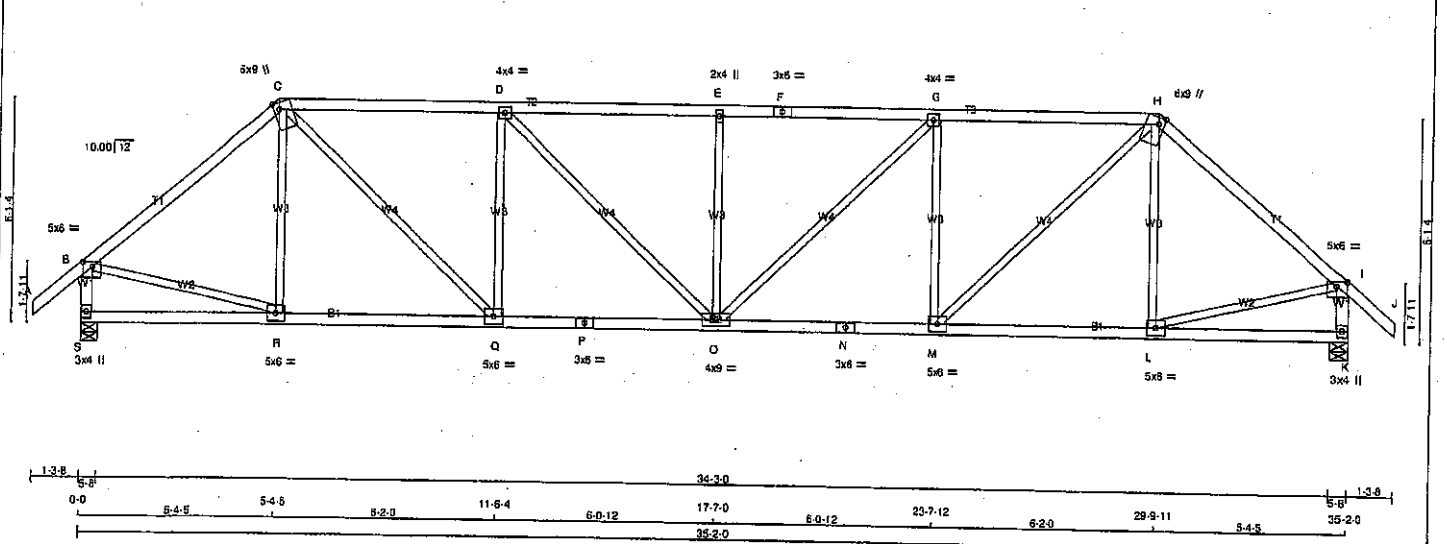

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - F	2x4	DRY No.2	SPF
F - H	2x4	DRY No.2	SPF
H - J	2x4	DRY No.2	SPF
S - B	2x4	DRY No.2	SPF
K - I	2x4	DRY No.2	SPF
S - P	2x4	DRY No.2	SPF
P - N	2x4	DRY No.2	SPF
N - K	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT
SPF

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMWV-p	MT20	5.0	6.0	1.50	3.00
C TTWW-m	MT20	6.0	9.0	Edge 1.75	
D TMWV-l	MT20	4.0	4.0		
E TMWV-w	MT20	2.0	4.0		
F TS-l	MT20	3.0	4.0		
G TMWV-l	MT20	4.0	4.0		
H TTWW-m	MT20	6.0	9.0	Edge 1.75	
I TMWV-p	MT20	5.0	6.0	1.50	3.00
K BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
S	2068	0	2068	0	0
K	2068	0	2068	0	0

UNFACTORED REACTIONS					
JT	1ST LCASE	MAX/MIN	COMPONENT	REACTIONS	
S	1458	971 / 0	0 / 0	0 / 0	489 / 0
K	1458	971 / 0	0 / 0	0 / 0	489 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.28 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLP)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	R-C	-246 / 7	0.14 (1)
B-C	-2004 / 0	-91.8	-91.8 0.64 (1)	4.11	C-Q	0 / 1538	0.35 (1)
C-D	-2653 / 0	-91.8	-91.8 0.74 (1)	3.50	Q-D	-943 / 0	0.55 (1)
D-E	-2878 / 0	-91.8	-91.8 0.78 (1)	3.28	D-O	0 / 450	0.10 (1)
E-F	-2878 / 0	-91.8	-91.8 0.78 (1)	3.28	O-E	-513 / 0	0.30 (1)
F-G	-2878 / 0	-91.8	-91.8 0.78 (1)	3.28	G-O	0 / 450	0.10 (1)
G-H	-2853 / 0	-91.8	-91.8 0.74 (1)	3.50	M-G	-943 / 0	0.55 (1)
H-I	-2004 / 0	-91.8	-91.8 0.64 (1)	4.11	M-H	0 / 1538	0.35 (1)
I-J	0 / 41	-91.8	-91.8 0.13 (1)	10.00	L-H	-246 / 7	0.14 (1)
S-B	-2026 / 0	0.0	0.0 0.22 (1)	5.94	B-R	0 / 1580	0.35 (1)
K-I	-2026 / 0	0.0	0.0 0.22 (1)	5.94	L-I	0 / 1580	0.35 (1)
S-R	0 / 0	-18.5	-18.5 0.14 (4)	10.00			
R-Q	0 / 1532	-18.5	-18.5 0.33 (1)	10.00			
Q-P	0 / 2653	-18.5	-18.5 0.45 (1)	10.00			
P-O	0 / 2653	-18.5	-18.5 0.49 (1)	10.00			
O-N	0 / 2653	-18.5	-18.5 0.49 (1)	10.00			
N-M	0 / 2653	-18.5	-18.5 0.49 (1)	10.00			
M-L	0 / 1532	-18.5	-18.5 0.33 (1)	10.00			
L-K	0 / 0	-18.5	-18.5 0.14 (4)	10.00			

TOTAL WEIGHT = 2 X 148 = 296 lb

DESIGN CRITERIA			
SPECIFIED LOADS:			
TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.16')
ALLOWABLE DEFL.(TL) = L/550 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.29')

CSI: TC=0.78/1.00 (E-G:1), BC=0.49/1.00 (M-O:1), WS=0.55/1.00 (G-M:1), SS=0.27/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
(PSI)	(PLI)	(PLI)			
MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	798	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.90 (B) (INPUT = 0.90)
JSI METAL = 0.95 (N) (INPUT = 1.00)

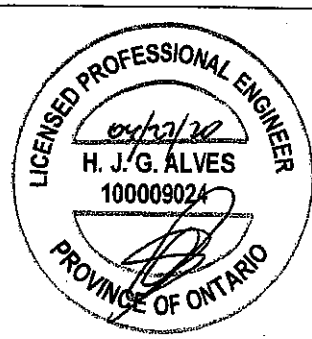

Structural component only
DWG# T-2007132

JOB NAME 408168	TRUSS NAME T4	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:34:52 2020 Page 1
 ID:DMCubINVR6TstFoe31v6l zns1i-EN1DfPipOXKsNAD1WqNU_?T6RbNZgQVnuM8oDzNBH
 Scale = 1:57.5

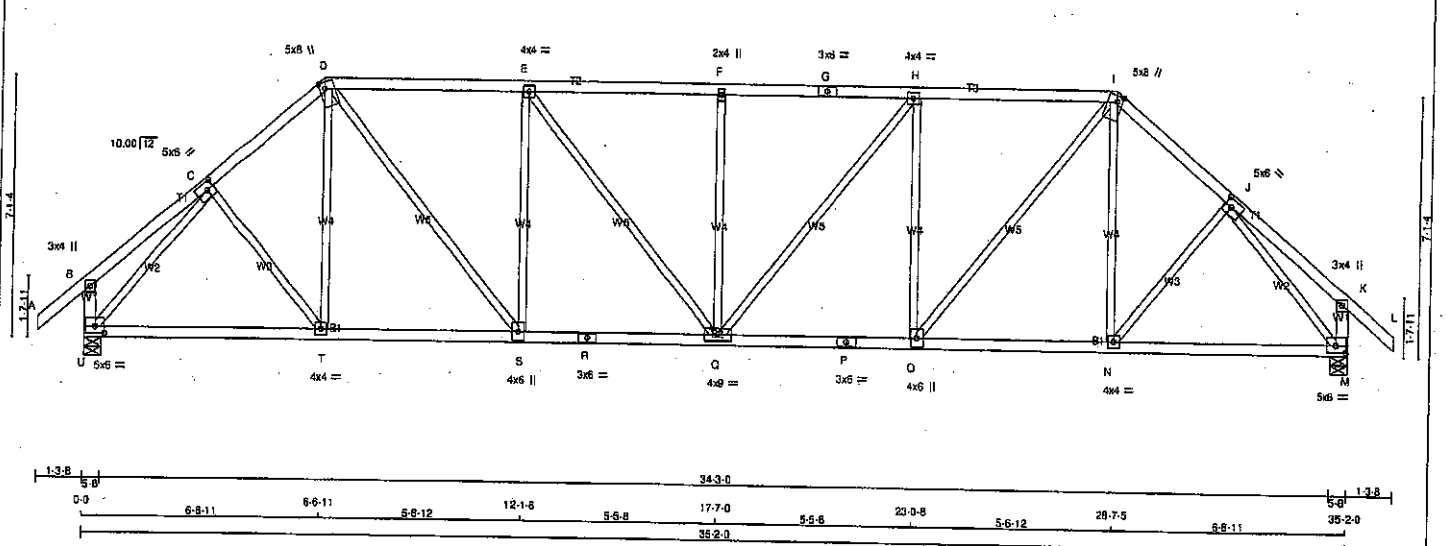

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
U - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+P	MT20	5.0	4.0	
C	TMWW-I	MT20	5.0	8.0	2.50 2.25
D	TMWW-I	MT20	5.0	8.0	2.00 1.75
E	TMWW-I	MT20	4.0	4.0	
F	TMWW-I	MT20	2.0	4.0	
G	TS-I	MT20	3.0	6.0	
H	TMWW-I	MT20	4.0	4.0	
I	TMWW-I	MT20	5.0	8.0	2.00 1.75
J	TMWW-I	MT20	5.0	8.0	2.50 2.25
K	TMV+P	MT20	3.0	4.0	
M	BMVW-I	MT20	5.0	6.0	2.25 3.00
N	BMVW-I	MT20	4.0	4.0	
O	BMVW-I	MT20	4.0	6.0	
P	BS-I	MT20	3.0	6.0	
Q	BMVW-I	MT20	4.0	9.0	
R	BS-I	MT20	3.0	6.0	
S	BMVW-I	MT20	4.0	6.0	
T	BMVW-I	MT20	4.0	4.0	
U	BMVW-I	MT20	5.0	6.0	2.25 3.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
U	2066	0	2066	0	5-8
M	2066	0	2066	0	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
U	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
M	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLINE SPACING = 3.77 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	0 / 41	C-T	0 / 156
B-C	0 / 19	D-S	0 / 76
C-D	-2023 / 0	E-Q	-850 / 0
D-E	-2308 / 0	F-R	0 / 361
E-F	-2534 / 0	G-H	-461 / 0
F-G	-2534 / 0	H-I	0 / 361
G-H	-2534 / 0	I-J	-850 / 0
H-I	-2308 / 0	J-K	0 / 1220
I-J	-2023 / 0	K-L	0 / 76
J-K	0 / 19	L-M	0 / 156
K-L	0 / 41	N-J	0 / 76
L-M	-246 / 0	O-K	-2277 / 0
M-K	-246 / 0	J-M	-2277 / 0
U-T	0 / 1433		
T-S	0 / 1535		
S-R	0 / 2308		
R-Q	0 / 2308		
Q-P	0 / 2308		
P-O	0 / 2308		
O-N	0 / 1535		
N-M	0 / 1433		

TOTAL WEIGHT = 2 X 162 = 323 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 in/c/c

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.13")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.23")
 CSI: TC=0.57/1.00 (E-F:1), BC=0.42/1.00 (O-Q:1),
 WB=0.98/1.00 (J-M:1), SL=0.24/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (I) (INPUT = 0.90)
 JSI METAL = 0.72 (P) (INPUT = 1.00)

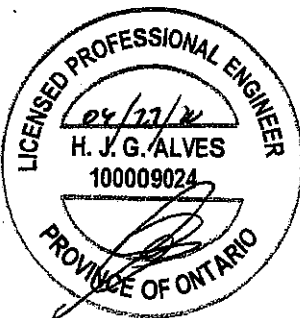

Structural component only
 DWG# T-2007133

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T5	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

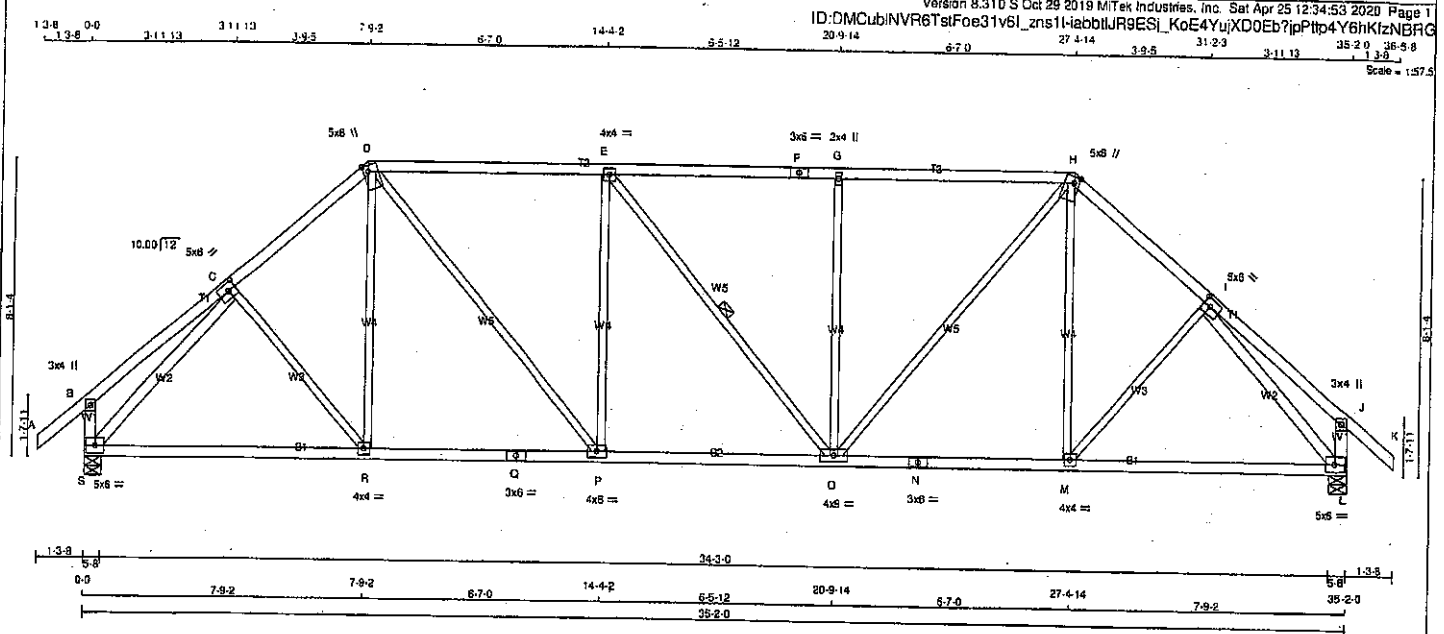

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - K	2x4	DRY	No.2	SPF	
S - B	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
S - Q	2x4	DRY	No.2	SPF	
Q - N	2x4	DRY	No.2	SPF	
N - L	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	
S - C	2x4	DRY	No.2	SPF	
I - L	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-t	MT20	5.0	8.0	2.50	2.50
D	TTVW+m	MT20	5.0	8.0	2.00	1.75
E	TMVW-t	MT20	4.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMVW+m	MT20	2.0	4.0		
H	TTVW+m	MT20	5.0	8.0	2.00	1.75
I	TMVW-t	MT20	5.0	8.0	2.50	2.50
J	TMV+p	MT20	3.0	4.0		
L	BMVW-t	MT20	5.0	8.0		
M	BMVW-t	MT20	4.0	4.0		
N	BS-t	MT20	3.0	6.0		
O	BMVWW-t	MT20	4.0	9.0		
P	BMVW-t	MT20	4.0	6.0		
Q	BS-t	MT20	3.0	6.0		
R	BMVW-t	MT20	4.0	4.0		
S	BMVW-t	MT20	5.0	8.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT	REQD
JT	GROSS REACTION	GROSS REACTION		BRG	BRG
	VERT	DOWN	HORZ	IN-SX	IN-SX
S	2066 0	2066 0	0	5-8	5-8
L	2066 0	2066 0	0	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX/MIN COMPONENT REACTIONS		PERM/LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX	IN-SX	IN-SX	IN-SX
S	1458	971/0	0/0	0/0	0/0	0/0	488/0	0/0	488/0	0/0	488/0	0/0	0/0
L	1458	971/0	0/0	0/0	0/0	0/0	488/0	0/0	488/0	0/0	488/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.81 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MAX. UNBRACED	MEMB.	FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM	TO	LENGTH	FR-TO		
A-B	0/41	-91.8	-91.8 0.13 (1)	10.00	C-R	0/64	0.02 (4)
B-C	0/26	-91.8	-91.8 0.21 (1)	10.00	R-D	0/126	0.04 (4)
C-D	-2006/0	-91.8	-91.8 0.29 (1)	4.50	D-P	0/988	0.22 (1)
D-E	-2169/0	-91.8	-91.8 0.73 (1)	3.81	P-E	-650/0	0.82 (1)
E-F	-2162/0	-91.8	-91.8 0.73 (1)	3.81	E-O	-2/0	0.00 (1)
F-G	-2162/0	-91.8	-91.8 0.73 (1)	3.81	O-G	-649/0	0.82 (1)
G-H	-2162/0	-91.8	-91.8 0.73 (1)	3.82	H-M	0/996	0.22 (1)
H-I	-2006/0	-91.8	-91.8 0.29 (1)	4.50	M-H	0/126	0.04 (4)
I-J	0/26	-91.8	-91.8 0.21 (1)	10.00	M-I	0/84	0.02 (4)
J-K	0/41	-91.8	-91.8 0.13 (1)	10.00	S-C	-2291/0	0.97 (1)
S-B	-264/0	0.0	0.0 0.08 (1)	7.81	I-L	-2291/0	0.97 (1)
L-J	-264/0	0.0	0.0 0.03 (1)	7.81			
S-R	0/1467	-18.5	-18.5 0.38 (1)	10.00			
R-Q	0/1519	-18.5	-18.5 0.39 (1)	10.00			
Q-P	0/1518	-18.5	-18.5 0.39 (1)	10.00			
P-O	0/2163	-18.5	-18.5 0.42 (1)	10.00			
O-N	0/1519	-18.5	-18.5 0.39 (1)	10.00			
N-M	0/1519	-18.5	-18.5 0.39 (1)	10.00			
M-L	0/1467	-18.5	-18.5 0.38 (1)	10.00			

TOTAL WEIGHT = 2 X 163 = 326 lb

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.5 PSF
DL	= 5.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF
SPACING	= 24.0 IN/C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.17')
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.10')
ALLOWABLE DEFL.(TL) = $L/360$ (1.17')
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.21')

CS1: TC=0.73/1.00 (D-E:1), SC=0.42/1.00 (O-P:1), WB=0.97/1.00 (I-L:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES						
MT20	PLATE GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
	618	354	1687	788	1987	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (I) (INPUT = 0.90)
JSI METAL = 0.56 (I) (INPUT = 1.00)

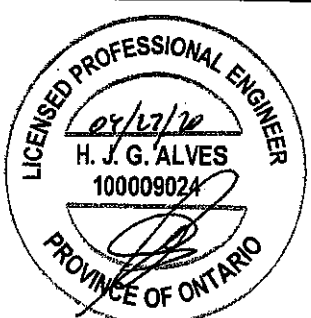

Structural component only
DWG# T-2007134

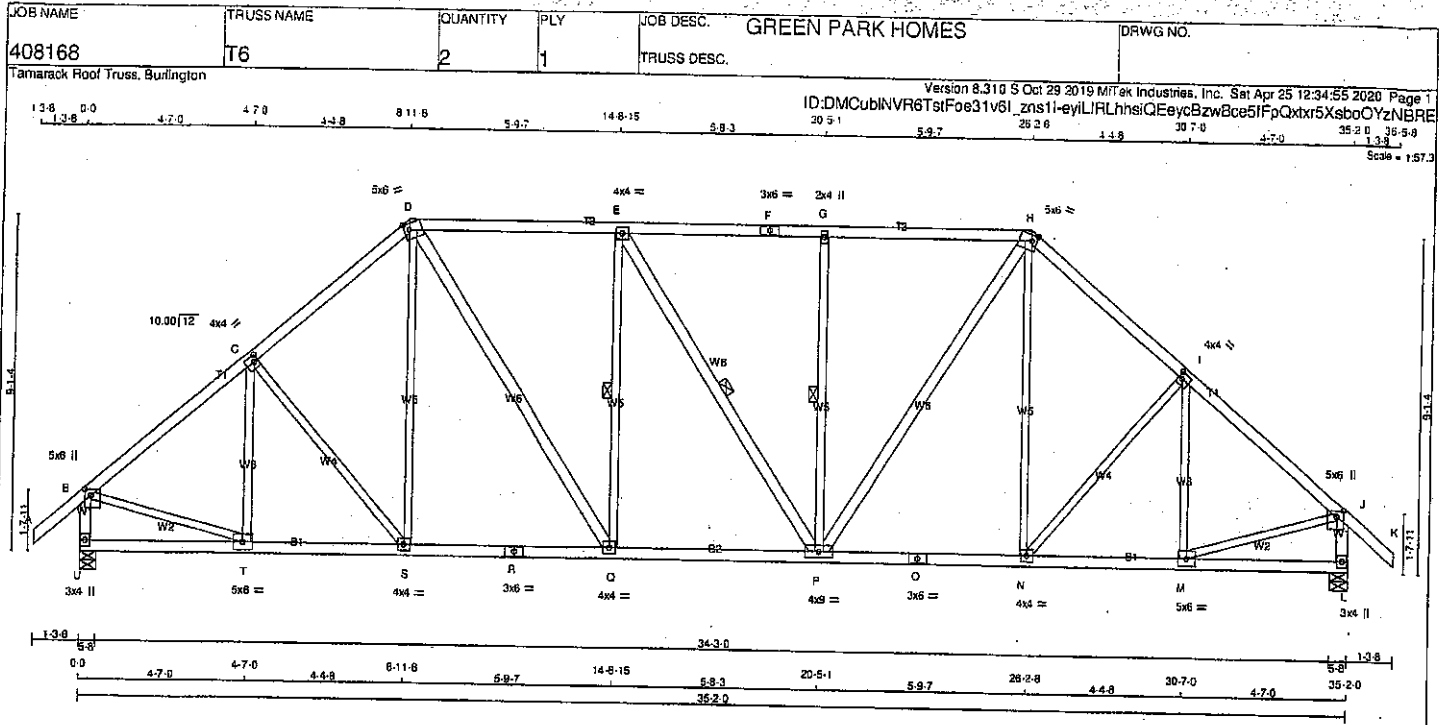

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR. SPF
A - D 2x4 DRY No.2
D - F 2x4 DRY No.2
F - H 2x4 DRY No.2
H - K 2x4 DRY No.2
K - L 2x4 DRY No.2
L - J 2x4 DRY No.2
J - I 2x4 DRY No.2
I - O 2x4 DRY No.2
O - L 2x4 DRY No.2
ALL WEBS 2x3 DRY No.2
EXCEPT
D - Q 2x4 DRY No.2
E - P 2x4 DRY No.2
P - H 2x4 DRY No.2
DRY: SEASONED LUMBER.

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT 2086	DOWN 0	UPLIFT 5-8	IN-SX 5-8
L 2086	0	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT COMBINED	SNOW	LIVE PERM. LIVE WIND DEAD SOIL
U 1458	971 / 0	0 / 0 0 / 0 488 / 0 0 / 0
L 1458	971 / 0	0 / 0 0 / 0 488 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.44 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.
1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, E-P, G-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)


CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 MAX (PLF)	MAX. UNBRACED LENGTH FR-TO
FR-TO			
A-B	0 / 41	-91.8 -91.8 0.13 (1)	10.00 T-C -357 / 0
B-C	-1994 / 0	-91.8 -91.8 0.30 (1)	4.53 C-S -121 / 0
C-D	-1957 / 0	-91.8 -91.8 0.29 (1)	4.57 S-D 0 / 189
D-E	-1923 / 0	-91.8 -91.8 0.40 (1)	4.44 D-Q 0 / 810
E-F	-1921 / 0	-91.8 -91.8 0.37 (1)	4.49 Q-E -569 / 0
F-G	-1921 / 0	-91.8 -91.8 0.37 (1)	4.49 E-P -3 / 0
G-H	-1921 / 0	-91.8 -91.8 0.40 (1)	4.45 P-G -568 / 0
H-I	-1957 / 0	-91.8 -91.8 0.29 (1)	4.57 P-H 0 / 807
I-J	-1994 / 0	-91.8 -91.8 0.30 (1)	4.53 H-N 0 / 189
J-K	0 / 41	-91.8 -91.8 0.13 (1)	10.00 N-I -121 / 0
U-B	-2028 / 0	0.0 0.0 0.22 (1)	5.94 M-I -358 / 0
L-J	-2028 / 0	0.0 0.0 0.22 (1)	5.94 B-T 0 / 1617
U-T	0 / 0	-18.5 -18.5 0.08 (4)	10.00 M-J 0 / 1617
T-S	0 / 1555	-18.5 -18.5 0.30 (1)	10.00
S-R	0 / 1477	-18.5 -18.5 0.30 (1)	10.00
R-Q	0 / 1477	-18.5 -18.5 0.30 (1)	10.00
Q-P	0 / 1923	-18.5 -18.5 0.38 (1)	10.00
P-O	0 / 1478	-18.5 -18.5 0.30 (1)	10.00
O-N	0 / 1478	-18.5 -18.5 0.30 (1)	10.00
N-M	0 / 1555	-18.5 -18.5 0.31 (1)	10.00
M-L	0 / 0	-18.5 -18.5 0.08 (4)	10.00

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 5.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN. C/C
LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015
THIS DESIGN COMPLIES WITH:
- PART 9 OF BCRC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014
(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD
ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/959 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/959 (0.16")
CSI: TC=0.40/1.00 (D-E:1), BC=0.38/1.00 (P-Q:1), WB=0.38/1.00 (B-T:1), SSI=0.25/1.00 (D-E:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10
COMPANION LIVE LOAD FACTOR = 1.00
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1897 789 1987 1856
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.89 (B) (INPUT = 0.80)
JSI METAL= 0.50 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007135

JOB NAME 408168	TRUSS NAME T7	QUANTITY 5	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MITak Industries, Inc. Sat Apr 25 12:34:56 2020 Page 1	

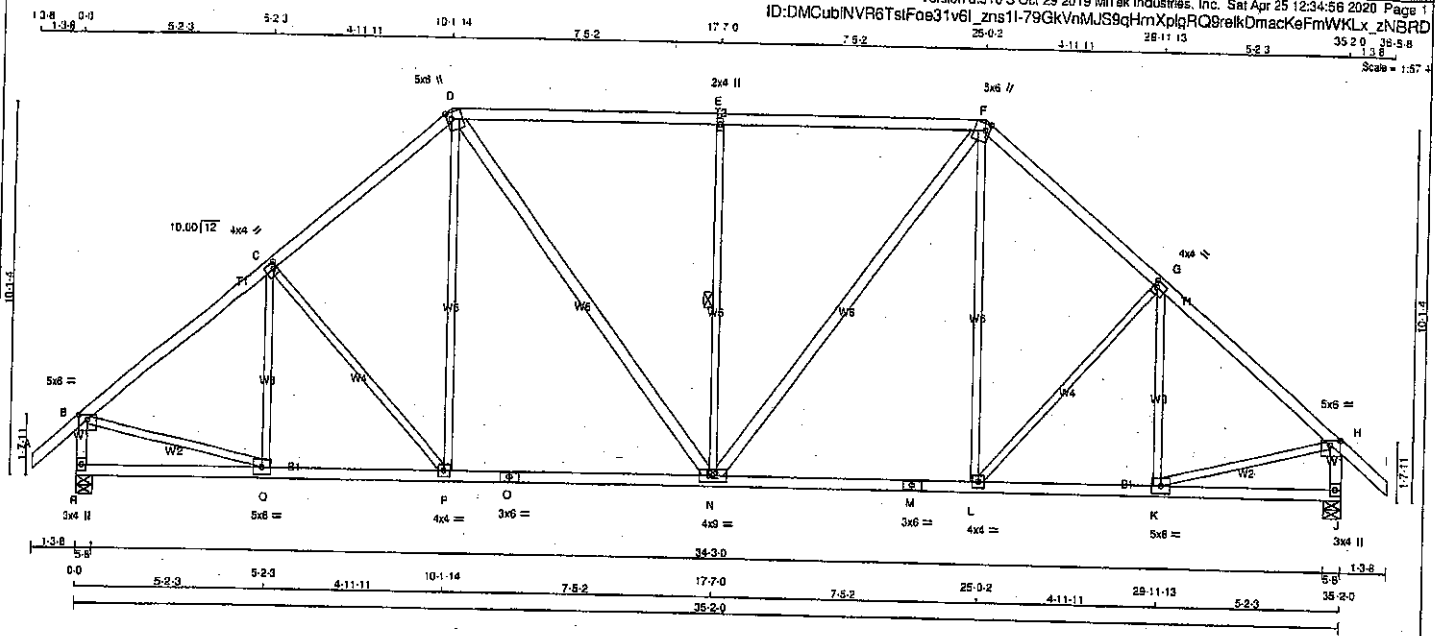

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER
A - D 2x4 DRY No.2
D - F 2x4 DRY No.2
F - I 2x4 DRY No.2
R - B 2x4 DRY No.2
J - H 2x4 DRY No.2
R - O 2x4 DRY No.2
O - M 2x4 DRY No.2
M - J 2x4 DRY No.2
ALL WEBS 2x3 DRY No.2
EXCEPT
D - N 2x4 DRY No.2
N - F 2x4 DRY No.2
DRY: SEASONED LUMBER.

N. L. G. A. RULES		CHORDS		LUMBER		DESCR.	
A - D	2x4	DRY	No.2			SPF	
D - F	2x4	DRY	No.2			SPF	
F - I	2x4	DRY	No.2			SPF	
R - B	2x4	DRY	No.2			SPF	
J - H	2x4	DRY	No.2			SPF	
R - O	2x4	DRY	No.2			SPF	
O - M	2x4	DRY	No.2			SPF	
M - J	2x4	DRY	No.2			SPF	
ALL WEBS	2x3	DRY	No.2			SPF	
EXCEPT							
D - N	2x4	DRY	No.2			SPF	
N - F	2x4	DRY	No.2			SPF	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER		BEARINGS		UNFACTORED REACTIONS	
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	
R	VERT 2066	DOWN 2066	0	5-8	
J	HORIZ 0	HORIZ 0	0	5-8	


UNFACTORED REACTIONS		1ST CASE		MAX./MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
R	1458	971 / 0	0 / 0	0 / 0	488 / 0
J	1458	971 / 0	0 / 0	0 / 0	488 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J
BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.98 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.
1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW
LOADING
TOTAL LOAD CASES: (4)

BMWW-I	MT20	5.0	6.0	CHORDS										WEBS										CALCULATED VERT. DEFL.(L) = L/999 (0.05")									
BMWW-I	MT20	4.0	4.0	MAX. FACTORED										MAX. FACTORED										ALLOWABLE DEFL.(TL)= L/360 (1.17")									
BS-I	MT20	3.0	6.0	MEMB. FORCE (LBS)										MEMB. FORCE (LBS)										CALCULATED VERT. DEFL.(TL) = L/999 (0.17")									
BMWWW-I	MT20	4.0	9.0	VERT. LOAD LC1 MAX										MAX. UNBRAC																			
BS-I	MT20	3.0	8.0	FROM TO										CS1 (LC)																			
BMWW-I	MT20	4.0	4.0	FR-TO										FR-TO																			
BMWW-I	MT20	5.0	6.0	A-B 0/41										Q-Q -302/0										0.17 (1)									
BMV1+p	MT20	3.0	4.0	B-C -2021/0										C-P -217/0										0.25 (1)									
				C-D -1908/0										P-D 0/278										0.05 (1)									
				D-E -1809/0										D-N 0/615										0.10 (1)									
				E-F -1809/0										N-E -538/0										0.58 (1)									
				F-G -1908/0										N-F 0/615										0.10 (1)									
				G-H -2021/0										L-F 0/278										0.06 (1)									
				H-I 0/41										L-G -217/0										0.25 (1)									
				I-J -2024/0										K-G -302/0										0.17 (1)									
				J-H -2024/0										B-Q 0/1629										0.37 (1)									
														K-H 0/1629										0.37 (1)									
				R-Q 0/0																													
				-18.5 -18.5 0.10 (4)										10.00																			

COMPANION LIVE LOAD FACTOR = 1.00									
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.									
NAIL VALUES									

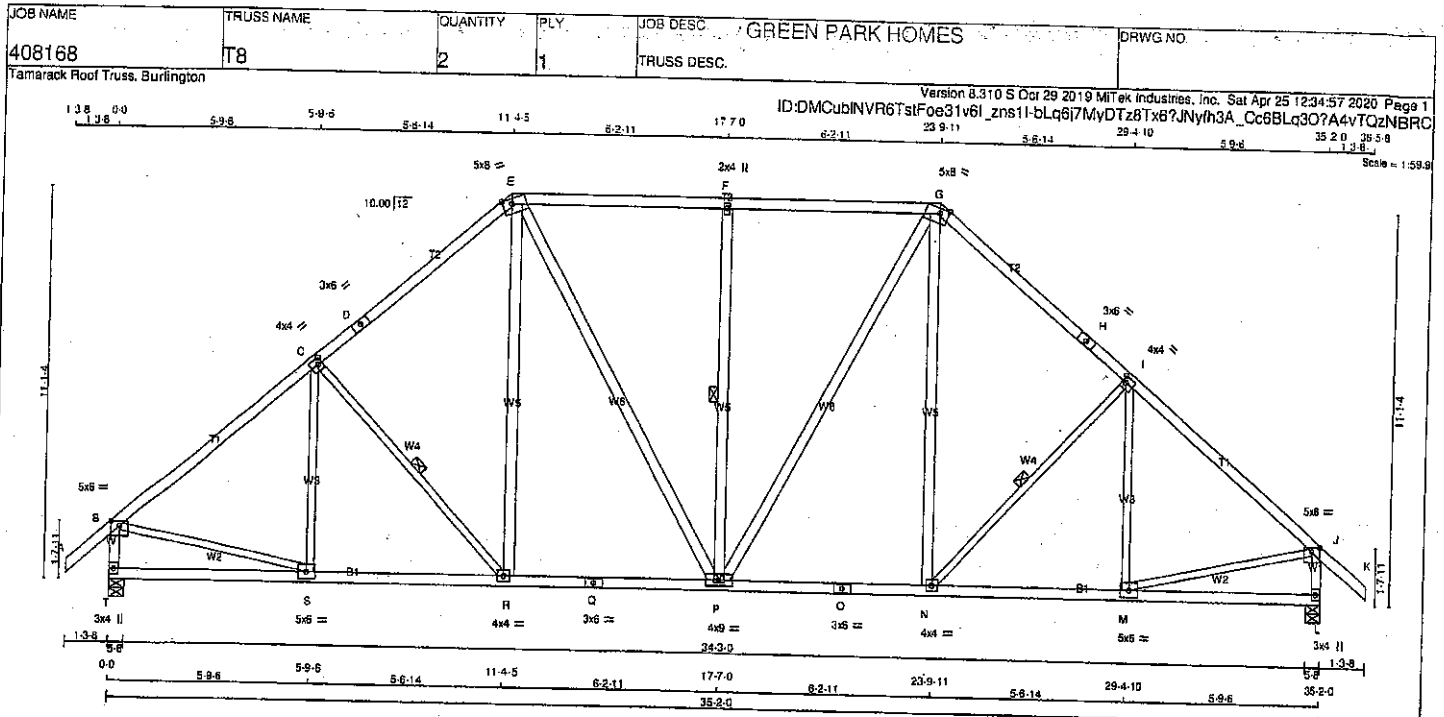

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
T - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
T - Q	2x4	DRY	No.2
Q - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS EXCEPT			
S - C	2x3	DRY	No.2
C - R	2x3	DRY	No.2
N - I	2x3	DRY	No.2
M - I	2x3	DRY	No.2
B - S	2x3	DRY	No.2
M - J	2x3	DRY	No.2

DRY, SEASONED LUMBER.

PLATES (tablets in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0	8.0 1.50 3.00
C	TMVW-i	MT20	4.0	4.0 2.00 1.25
D	TS-i	MT20	3.0	6.0
E	TTVW-m	MT20	5.0	8.0 Edge 3.00
F	TMVW-w	MT20	5.0	8.0
G	TTVW-m	MT20	5.0	8.0 Edge 3.00
H	TS-i	MT20	3.0	6.0
I	TMVW-i	MT20	4.0	4.0 2.00 1.25
J	TMVW-p	MT20	5.0	8.0 1.50 3.00
L	BMV1-p	MT20	3.0	4.0
M	BMVW-i	MT20	5.0	5.0
N	BMVW-i	MT20	4.0	4.0
O	BS-i	MT20	3.0	6.0
P	BMVW-w-i	MT20	4.0	9.0
Q	BS-i	MT20	3.0	6.0
R	BMVW-i	MT20	4.0	4.0
S	BMVW-i	MT20	5.0	6.0
T	BMV1-p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
T	2068	0	2066	0	0
L	2066	0	2066	0	0

UNFACTORED REACTIONS

JT	1ST LOOSE COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
T	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.27 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-R, F-P, I-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. VERT. LOAD (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. VERT. LOAD (LC)	MAX. VERT. LOAD (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 41	-91.8	-91.8 0.13 (1)	S-C	-245 / 10	0.17 (1)	
B-C	-2039 / 0	-91.8	-91.8 0.50 (1)	C-R	-314 / 0	0.15 (1)	
C-D	-1844 / 0	-91.8	-91.8 0.46 (1)	R-E	0 / 338	0.05 (1)	
D-E	-1844 / 0	-91.8	-91.8 0.46 (1)	E-P	0 / 489	0.08 (1)	
E-F	-1821 / 0	-91.8	-91.8 0.50 (1)	P-F	-899 / 0	0.45 (1)	
F-G	-1821 / 0	-91.8	-91.8 0.50 (1)	P-G	0 / 489	0.08 (1)	
G-H	-1844 / 0	-91.8	-91.8 0.46 (1)	N-G	0 / 338	0.05 (1)	
H-I	-1844 / 0	-91.8	-91.8 0.46 (1)	I-N	-314 / 0	0.15 (1)	
I-J	-2039 / 0	-91.8	-91.8 0.50 (1)	M-I	-245 / 10	0.17 (1)	
J-K	0 / 41	-91.8	-91.8 0.13 (1)	S-S	0 / 1837	0.37 (1)	
T-B	-2021 / 0	0.0	0.0 0.21 (1)	M-J	0 / 1837	0.37 (1)	
L-J	-2021 / 0	0.0	0.0 0.21 (1)				
T-S	0 / 0	-18.5	-18.5 0.14 (4)				
S-R	0 / 1597	-18.5	-18.5 0.33 (1)				
R-Q	0 / 1387	-18.5	-18.5 0.30 (1)				
Q-P	0 / 1387	-18.5	-18.5 0.30 (1)				
P-O	0 / 1387	-18.5	-18.5 0.30 (1)				
O-N	0 / 1387	-18.5	-18.5 0.30 (1)				
N-M	0 / 1597	-18.5	-18.5 0.33 (1)				
M-L	0 / 0	-18.5	-18.5 0.14 (4)				

TOTAL WEIGHT = 2 X 190 = 380 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.8 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TO=0.50/1.00 (E-F-1), BO=0.33/1.00 (M-N-1), WS=0.45/1.00 (F-P-1), SS=0.28/1.00 (E-F-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP=0.89 (J) (INPUT = 0.90)
JSI METAL=0.47 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007137

JOB NAME 408168	TRUSS NAME T9	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

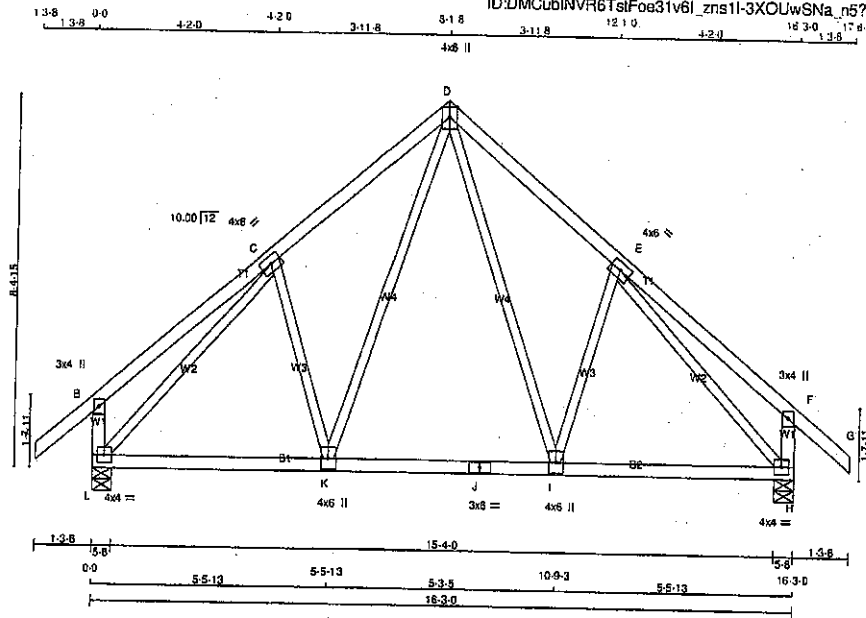

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:58 2020 Page 1
ID:DMCubINVR6TstFoa31v6l_zns11-3XOUwsNa_n5?55hBISUUEGjd_0Uq4EhYDqpS?tzNBAB

Scale: 1/4"=1'

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2	
D - G	2x4	DRY	No.2	
L - B	2x4	DRY	No.2	
H - F	2x4	DRY	No.2	
L - J	2x4	DRY	No.2	
J - H	2x4	DRY	No.2	

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0		
C	TMVW-t	MT20	4.0	6.0		
D	TTVW-p	MT20	4.0	6.0		
E	TMVW-t	MT20	4.0	6.0		
F	TMV-p	MT20	3.0	4.0		
H	BMVW1-t	MT20	4.0	4.0		
I	BMVW-t	MT20	4.0	6.0		
J	BS-t	MT20	3.0	6.0		
K	BMVW-t	MT20	4.0	6.0		
L	BMVW1-t	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
L	1023	0	1023	0
H	1023	0	1023	0

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	721	487 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0
H	721	487 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORIZ. LOAD (LC)	MAX. UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO						FR-TO			
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	D-I	0 / 330	0.07 (1)	10.00
B-C	0 / 28	-91.8	-91.8	0.24 (1)	10.00	I-E	-216 / 0	0.09 (1)	10.00
C-D	-745 / 0	-91.8	-91.8	0.19 (1)	8.25	K-D	0 / 330	0.07 (1)	10.00
D-E	-745 / 0	-91.8	-91.8	0.19 (1)	8.25	C-K	-216 / 0	0.09 (1)	10.00
E-F	0 / 28	-91.8	-91.8	0.24 (1)	10.00	L-C	-943 / 0	0.61 (1)	10.00
F-G	0 / 41	-91.8	-91.8	0.13 (1)	10.00	E-H	-943 / 0	0.61 (1)	10.00
L-B	-267 / 0	0.0	0.0	0.03 (1)	7.81				
H-F	-267 / 0	0.0	0.0	0.03 (1)	7.81				
L-K	0 / 616	-18.5	-18.5	0.17 (4)	10.00				
K-J	0 / 449	-18.5	-18.5	0.16 (4)	10.00				
J-I	0 / 449	-18.5	-18.5	0.16 (4)	10.00				
I-H	0 / 616	-18.5	-18.5	0.17 (4)	10.00				

TOTAL WEIGHT = 6 X 80 = 481 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
DL	=	6.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/989 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/989 (0.04")

CSI: TC=0.24/1.00 (B-C:1), BC=0.17/1.00 (H-I:4), WB=0.61/1.00 (C-L:1), SSI=0.14/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	518	354	1697
	518	354	1697

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.75 (C) (INPUT = 0.90)
JSI METAL = 0.25 (C) (INPUT = 1.00)

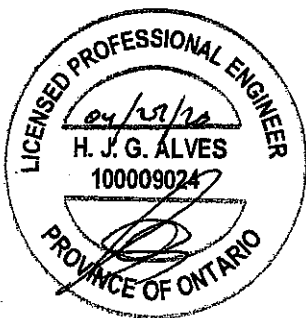


Structural component only
DWG# T-2007138

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC	DRWG NO.
408168	G9	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version: 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 12:34:40 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns1f-b4lh8J9HDFpZxKJkpJ9gVTzANmNyiCAu40SVMwzNBRT

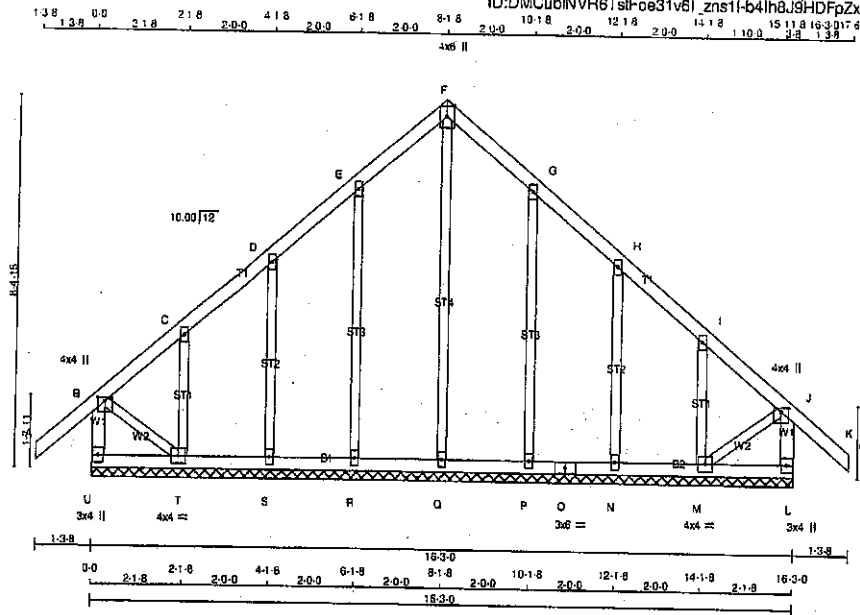

Scale: 1/4"=1'

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - F	2x4	DRY	No.2
F - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2

ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER			

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C, D, E, G, H, I					
C TMVW+w	MT20	2.0	4.0		
F TTW+p	MT20	4.0	6.0		
J TMVW+p	MT20	4.0	4.0	1.00	2.00
L BMV1+p	MT20	3.0	4.0		
M BMVW1-t	MT20	4.0	4.0		
N, P, Q, R, S					
N BMV1+w	MT20	2.0	4.0		
O BS-t	MT20	3.0	6.0		
T BMVW1-t	MT20	4.0	4.0		
U BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSF (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSF (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8 -91.8 0.13 (1)	10.00	Q-F	-124 / 0	0.17 (1)	
B-C	-28 / 0	-91.8 -91.8 0.05 (1)	6.25	R-E	-210 / 0	0.16 (1)	
C-D	-36 / 0	-91.8 -91.8 0.05 (1)	6.25	S-D	-169 / 0	0.09 (1)	
D-E	-24 / 0	-91.8 -91.8 0.05 (1)	6.25	T-C	-205 / 0	0.04 (1)	
E-F	-36 / 0	-91.8 -91.8 0.05 (1)	6.25	P-G	-210 / 0	0.16 (1)	
F-G	-36 / 0	-91.8 -91.8 0.05 (1)	6.25	N-H	-169 / 0	0.08 (1)	
G-H	-24 / 0	-91.8 -91.8 0.05 (1)	6.25	M-I	-205 / 0	0.04 (1)	
H-I	-36 / 0	-91.8 -91.8 0.05 (1)	6.25	B-T	0 / 37	0.01 (1)	
I-J	-28 / 0	-91.8 -91.8 0.05 (1)	6.25	M-J	0 / 37	0.01 (1)	
J-K	0 / 41	-91.8 -91.8 0.13 (1)	10.00				
U-B	-248 / 0	0.0 0.0 0.03 (1)	7.61				
L-J	-248 / 0	0.0 0.0 0.03 (1)	7.61				
U-T	0 / 0	-18.5 -18.5 0.02 (4)	10.00				
T-S	0 / 25	-18.5 -18.5 0.02 (4)	10.00				
S-R	0 / 21	-18.5 -18.5 0.02 (4)	10.00				
R-Q	0 / 18	-18.5 -18.5 0.02 (4)	10.00				
Q-P	0 / 18	-18.5 -18.5 0.02 (4)	10.00				
P-O	0 / 21	-18.5 -18.5 0.02 (4)	10.00				
O-N	0 / 21	-18.5 -18.5 0.02 (4)	10.00				
N-M	0 / 25	-18.5 -18.5 0.02 (4)	10.00				
M-L	0 / 0	-18.5 -18.5 0.02 (4)	10.00				

TOTAL WEIGHT = 81 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSF: TC=0.13/1.00 (A-B:1), BC=0.02/1.00 (M-N:4), WB=0.17/1.00 (F-Q:1), SS=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
	(PS)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.52 (T) (INPUT = 0.50)
JSI METAL= 0.11 (G) (INPUT = 1.00)



Structural component only
DWG# T-2007123

JOB NAME 408168	TRUSS NAME T10	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

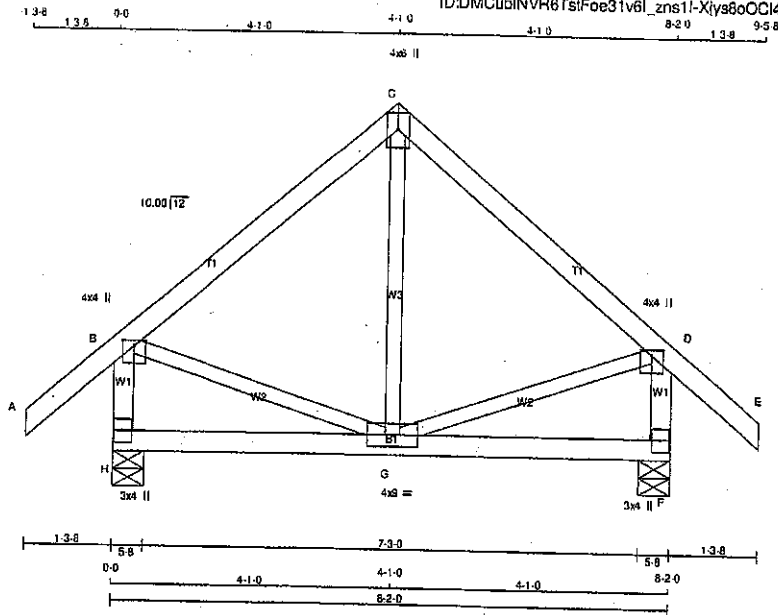

LUMBER	N.L.G.A. RULES	CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2		
C - E	2x4	DRY	No.2		
H - B	2x4	DRY	No.2		
F - D	2x4	DRY	No.2		
H - F	2x4	DRY	No.2		

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW+p	MT20	4.0	6.0	Edge	
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV+p	MT20	3.0	4.0		
G	BMVWW-t	MT20	4.0	9.0		
H	BMV+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED		MAXIMUM FACTORED		INPUT	REQD
	GROSS REACTION	DOWN	GROSS REACTION	UP		
JT	VERT	HORZ	DOWN	HORZ	BRG	BRG
H	577	0	577	0	5-8	5-8
F	577	0	577	0	5-8	5-8

UNFACTORED REACTIONS

1ST LOASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
H	408	280 / 0	0 / 0	0 / 0	0 / 0	126 / 0
F	408	280 / 0	0 / 0	0 / 0	0 / 0	126 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS			MAX. UNBRACED LENGTH	FR-TO	WEBS		
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (LC)			MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORZ. LOAD (LC)
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	G-C	-37 / 57	0.02 (4)
B-C	-284 / 0	-91.8	-91.8	0.20 (1)	6.25	B-G	0 / 213	0.05 (1)
C-D	-284 / 0	-91.8	-91.8	0.20 (1)	6.25	G-D	0 / 213	0.05 (1)
D-E	0 / 41	-91.8	-91.8	0.13 (1)	10.00			
H-B	-548 / 0	0.0	0.0	0.08 (1)	7.81			
F-D	-548 / 0	0.0	0.0	0.06 (1)	7.81			
H-G	0 / 0	-18.5	-18.5	0.09 (4)	10.00			
G-F	0 / 0	-18.5	-18.5	0.09 (4)	10.00			

TOTAL WEIGHT = 39 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
BOT CH.	LL	=	6.0	PSF
	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.27")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.27")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.01")

CSI: TO=0.20/1.00 (B-C:1), BC=0.09/1.00 (F-G:4),
WB=0.06/1.00 (D-G:1), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667
	788	1987	1655

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.46 (D) (INPUT = 0.90)
JSI METAL= 0.12 (D) (INPUT = 1.00)

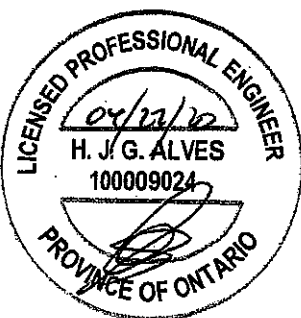

Structural component only
DWG# T-2007139

JOB NAME 408168	TRUSS NAME G10	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

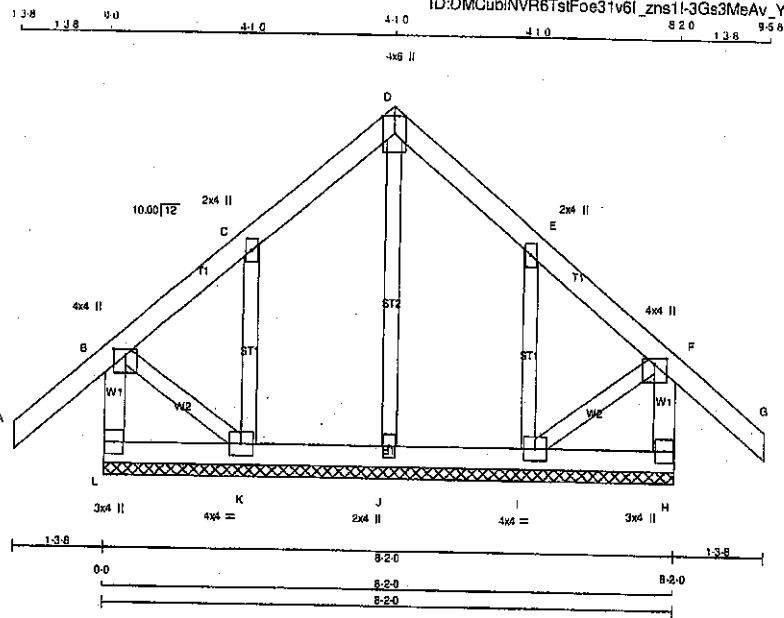

LUMBER

N. L. G. A. RULE	CHORDS	SIZE	LUMBER
L - B	2x4	DRY	No.2
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
ALL GABLE WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C TMVW+w	MT20	2.0	4.0		
D TTW+p	MT20	4.0	6.0	Edge	
E TMVW+w	MT20	2.0	4.0		
F TMVW+p	MT20	4.0	4.0	1.00	2.00
H BMV1+p	MT20	3.0	4.0		
I BMVW1-i	MT20	4.0	4.0		
J BMV1+w	MT20	2.0	4.0		
K BMVW1-i	MT20	4.0	4.0		
L BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	FACTORED LOAD (PLF)	MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	WEBS MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO						FR-TO		
L-B	-224 / 0	0.0	0.0	0.02 (1)	7.81	J-D	-128 / 0	0.05 (1)
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	K-C	-227 / 0	0.04 (1)
B-C	-11 / 0	-91.8	-91.8	0.08 (1)	6.25	I-E	-227 / 0	0.04 (1)
C-D	-31 / 0	-91.8	-91.8	0.08 (1)	6.25	B-K	0 / 24	0.01 (1)
D-E	-31 / 0	-91.8	-91.8	0.08 (1)	6.25	I-F	0 / 24	0.01 (1)
E-F	-11 / 0	-91.8	-91.8	0.08 (1)	6.25			
F-G	0 / 41	-91.8	-91.8	0.13 (1)	10.00			
H-F	-224 / 0	0.0	0.0	0.02 (1)	7.81			
L-K	0 / 0	-18.5	-18.5	0.02 (4)	10.00			
K-J	0 / 13	-18.5	-18.5	0.02 (4)	10.00			
J-I	0 / 13	-18.5	-18.5	0.02 (4)	10.00			
I-H	0 / 0	-18.5	-18.5	0.02 (4)	10.00			

TOTAL WEIGHT = 40 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (A-B:1), BC=0.02/1.00 (J-K:4), WB=0.05/1.00 (D-J:1), SS=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	618	354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.17 (C) (INPUT = 0.80)
JSI METAL = 0.12 (C) (INPUT = 1.00)

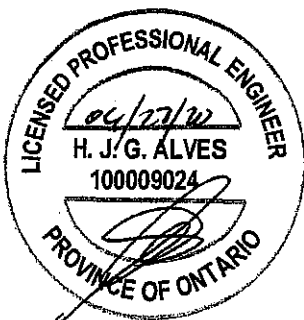

Structural component only
DWG# T-2007124

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T11	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
TRUSS DESC.					

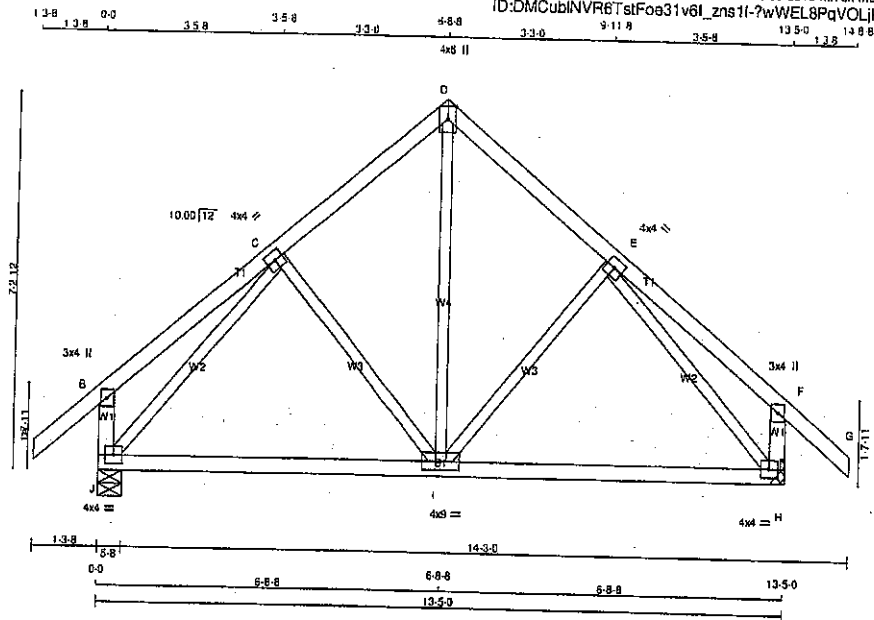

<u>LUMBER</u>			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-i	MT20	4.0	4.0		
D	TTW+p	MT20	4.0	8.0		Edge
E	TMWW-i	MT20	4.0	4.0		
F	TMV+p	MT20	3.0	4.0		
H	BMVW-i	MT20	4.0	4.0		
I	BMWW-i	MT20	4.0	9.0		
J	BMVW-i	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

DESCR.	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
J	887	0	887	0
H	887	0	887	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3.8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	811	414 / 0	0 / 0	0 / 0	0 / 0	198 / 0	0 / 0	0 / 0
H	811	414 / 0	0 / 0	0 / 0	0 / 0	198 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED	WEBS	MAX. FACTORED
FR-TO		(LBS)	(PLF)			(LC)	UNBRAC		(LBS)		(LBS)
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00			I-D	0 / 382	0.09 (1)	
B-C	0 / 23	-91.8	-91.8	0.13 (1)	10.00			I-E	-149 / 0	0.07 (1)	
C-D	-509 / 0	-91.8	-91.8	0.13 (1)	8.25			C-I	-149 / 0	0.07 (1)	
D-E	-509 / 0	-91.8	-91.8	0.13 (1)	6.25			J-C	-742 / 0	0.33 (1)	
E-F	0 / 23	-91.8	-91.8	0.13 (1)	10.00			E-H	-742 / 0	0.33 (1)	
F-G	0 / 41	-91.8	-91.8	0.13 (1)	10.00						
J-B	-244 / 0	0.0	0.0	0.03 (1)	7.81						
H-F	-244 / 0	0.0	0.0	0.03 (1)	7.81						
J-I	0 / 469	-18.5	-18.5	0.27 (4)	10.00						
I-H	0 / 469	-18.5	-18.5	0.27 (4)	10.00						

TOTAL WEIGHT = 3 X 64 = 191 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.45")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01")
ALLOWABLE DEFL. (TL) = $L/360$ (0.45")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.05")

CSI: TC=0.16/1.00 (E-F:1), BC=0.27/1.00 (I-J:4), WB=0.33/1.00 (E-H:1), SS=0.11/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (E) (INPUT = 0.90)
JSI METAL= 0.27 (E) (INPUT = 1.00)



Structural component only
DWG# T-2007140

JOB NAME 408168	TRUSS NAME G11	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

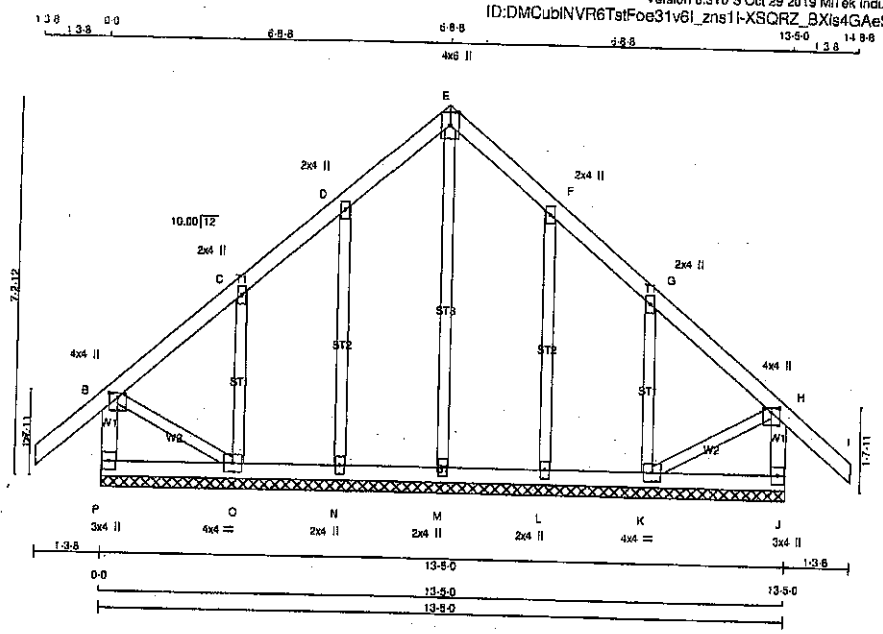

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
P - B	2x4	DRY	No. 2
A - E	2x4	DRY	No. 2
E - I	2x4	DRY	No. 2
J - H	2x4	DRY	No. 2
P - J	2x4	DRY	No. 2
ALL WEBS	2x3	DRY	No. 2
ALL GABLE WEBS	2x3	DRY	No. 2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2'-0" O.C.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C, D, F, G					
C TMVW+p	MT20	2.0	4.0		
E TTW+p	MT20	4.0	6.0	Edge	
H TMVW+p	MT20	4.0	4.0	1.00	2.00
J BMV1+p	MT20	3.0	4.0		
K BMVW1-l	MT20	4.0	4.0		
L, M, N					
L BMV1+p	MT20	2.0	4.0		
O BMVW1-l	MT20	4.0	4.0		
P BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S).

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS (LC)	MAX. FACTORED UNBRACED LENGTH	WEBS			
					MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS (LC)	
FR-TO		FROM TO			FR-TO			
P-B	-263 / 0	0.0	0.0	0.03 (1)	7.81	M-E	-128 / 0	0.11 (1)
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	N-D	-190 / 0	0.09 (1)
B-C	-24 / 0	-91.8	-91.8	0.06 (1)	8.25	O-C	-239 / 0	0.06 (1)
C-D	-38 / 0	-91.8	-91.8	0.08 (1)	6.25	L-F	-190 / 0	0.09 (1)
D-E	-35 / 0	-91.8	-91.8	0.05 (1)	8.25	K-G	-239 / 0	0.06 (1)
E-F	-35 / 0	-91.8	-91.8	0.05 (1)	8.25	B-C	0 / 32	0.01 (1)
F-G	-38 / 0	-91.8	-91.8	0.08 (1)	6.25	K-H	0 / 32	0.01 (1)
G-H	-24 / 0	-91.8	-91.8	0.06 (1)	10.00			
H-I	0 / 41	-91.8	-91.8	0.13 (1)	7.81			
J-H	-263 / 0	0.0	0.0	0.03 (1)	7.81			
P-O	0 / 0	-18.5	-18.5	0.03 (4)	10.00			
O-N	0 / 22	-18.5	-18.5	0.03 (4)	10.00			
N-M	0 / 19	-18.5	-18.5	0.02 (4)	10.00			
M-L	0 / 19	-18.5	-18.5	0.02 (4)	10.00			
L-K	0 / 22	-18.5	-18.5	0.03 (4)	10.00			
K-J	0 / 0	-18.5	-18.5	0.03 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	PSF
DL	25.6	PSF
BOT CH.	LL	PSF
DL	6.0	PSF
DL	0.0	PSF
DL	7.4	PSF
TOTAL LOAD	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (H-I), BC=0.03/1.00 (K-L), WB=0.11/1.00 (E-M), SSI=0.08/1.00 (G-H)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
618	354	1867
786	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.20 (B) (INPUT = 0.90)

JSI METAL = 0.13 (G) (INPUT = 1.00)

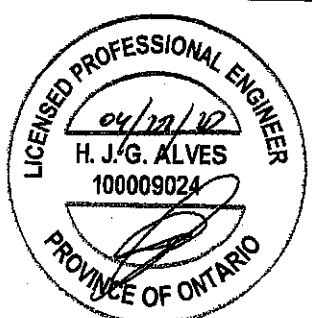

Structural component only
DWG# T-2007125

JOB NAME 408168	TRUSS NAME T12	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 12:35:01 2020 Page 1					
ID:DMCubINVR6TstFoe31v6I_zns1T-T63dYUPSGItayZPmYD1bsvLJKEW1HhI_vn26cCzNBR8					
Scale = 1:16.8					

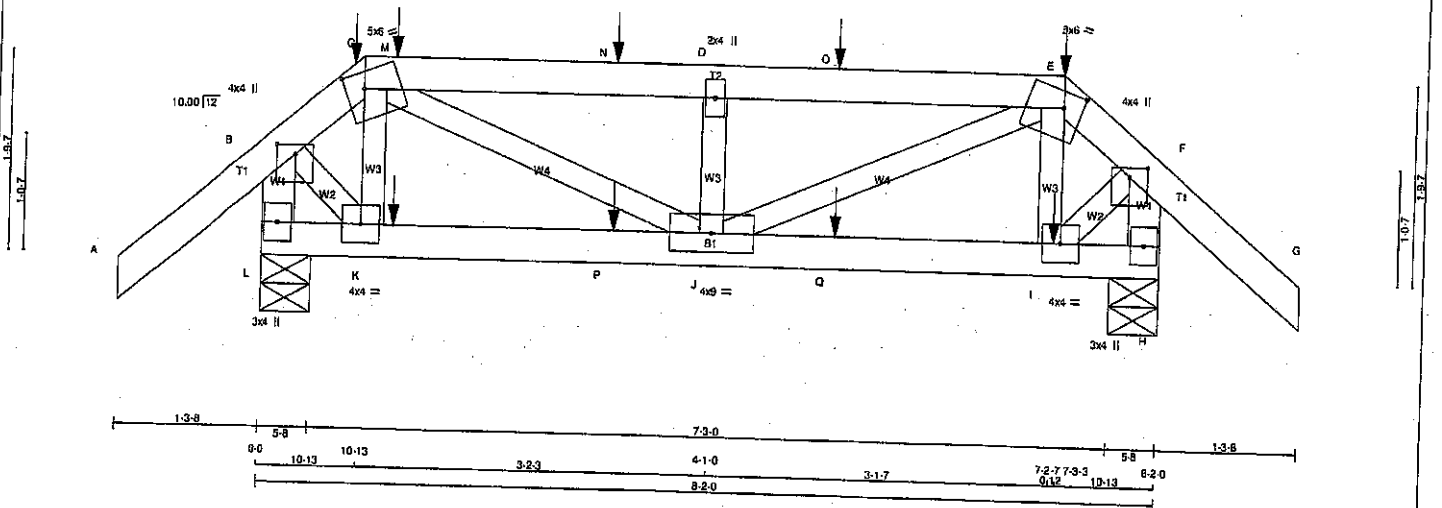

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER
A - C 2x4 DRY No.2
C - E 2x4 DRY No.2
E - G 2x4 DRY No.2
L - B 2x4 DRY No.2
H - F 2x4 DRY No.2
L - H 2x4 DRY No.2
ALL WEBS 2x3 DRY No.2
EXCEPT
DRY: SEASONED LUMBER.

DESCR.	SPF	FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	SPF	GROSS REACTION	GROSS REACTION	BRG	BRG
L	SPF	VERT 913	DOWN 913	0	5-8
H	SPF	911	0	0	5-8

1ST LOOSE	MAX/MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
L	642 442 / 0 0 / 0 0 / 0 199 / 0 0 / 0
H	641 437 / 0 0 / 0 0 / 0 204 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H
BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.82 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

CHORDS	MEMB.	FORCE (LBS)	FACTORED	VERT. LOAD (LBS)	MAX. FACTORED	WEBS	MEMB.	FORCE (LBS)	FACTORED	VERT. LOAD (LBS)	MAX. FACTORED
FR-TO						FR-TO					
A-B	0 / 41	-91.8	-91.8	0.14 (1)	10.00	J-D	-487 / 0	0.08 (1)			
B-C	-631 / 0	-91.8	-91.8	0.14 (1)	10.00	K-C	-155 / 0	0.02 (1)			
C-M	-1054 / 0	-91.8	-91.8	0.23 (1)	5.82	C-J	0 / 700	0.17 (1)			
M-N	-1054 / 0	-91.8	-91.8	0.23 (1)	5.82	B-K	0 / 525	0.13 (1)			
N-D	-1054 / 0	-91.8	-91.8	0.23 (1)	5.82	J-E	-149 / 0	0.02 (1)			
D-O	-1054 / 0	-91.8	-91.8	0.23 (1)	5.82	E-F	0 / 598	0.17 (1)			
O-E	-1054 / 0	-91.8	-91.8	0.23 (1)	5.82	F-F	0 / 526	0.13 (1)			
E-F	-632 / 0	-91.8	-91.8	0.14 (1)	6.25						
F-G	0 / 41	-91.8	-91.8	0.14 (1)	10.00						
L-B	-938 / 0	0.0	0.0	0.10 (1)	7.81						
H-F	-937 / 0	0.0	0.0	0.10 (1)	7.81						
L-K	0 / 0	-18.5	-18.5	0.05 (1)	10.00						
K-P	0 / 420	-18.5	-18.5	0.13 (1)	10.00						
P-J	0 / 420	-18.5	-18.5	0.13 (1)	10.00						
J-Q	0 / 421	-18.5	-18.5	0.14 (1)	10.00						
Q-I	0 / 421	-18.5	-18.5	0.14 (1)	10.00						
I-H	0 / 0	-18.5	-18.5	0.05 (1)	10.00						

(LBS)		(PLF)	CSI (LC)	UNBRAC	MEMB.	FORCE	MAX
FR-TO		FROM TO		LENGTH	FR-TO	(LBS)	CSI (LC)
A-B	0 / 41	-91.8	-91.8 0.14 (1)	10.00	J-D	-487 / 0	0.08 (1)
B-C	-631 / 0	-91.8	-91.8 0.14 (1)	6.25	K-C	-156 / 0	0.02 (1)
C-M	-1054 / 0	-91.8	-91.8 0.23 (1)	5.82	C-J	0 / 700	0.17 (1)
M-N	-1054 / 0	-91.8	-91.8 0.23 (1)	5.82	B-K	0 / 525	0.13 (1)
N-D	-1054 / 0	-91.8	-91.8 0.23 (1)				

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018 , CBC 2012 , ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

CONNECTION REQUIREMENTS
1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.


DESIGN CRITERIA
*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN./C/C
LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12
*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015
THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 088-14
- TPIC 2011, TPIC 2014
DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.27")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.27")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")
CSR: TC=0.23/1.00 (C-D:1), BC=0.14/1.00 (H-J:1),
WB=0.17/1.00 (C-J:1), SSI=0.22/1.00 (C-C:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00
COMPANION LIVE LOAD FACTOR = 1.00
AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1655
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.

Continued on page 2

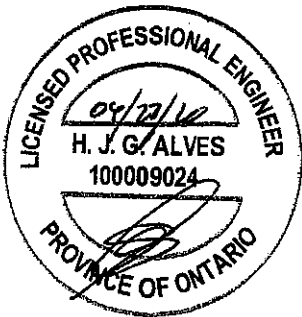


Structural component only
DWG# T-2007-141

JOB NAME 408168	TRUSS NAME T13	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:35:03 2020 Page 1
ID:DMCub\NVR6TstFoe31v6L_zns11-PVBNZARioJ\BsZ9fe33xKQvZ1CWYJHN5XDq4zNBR6

Scale = 1:17.3

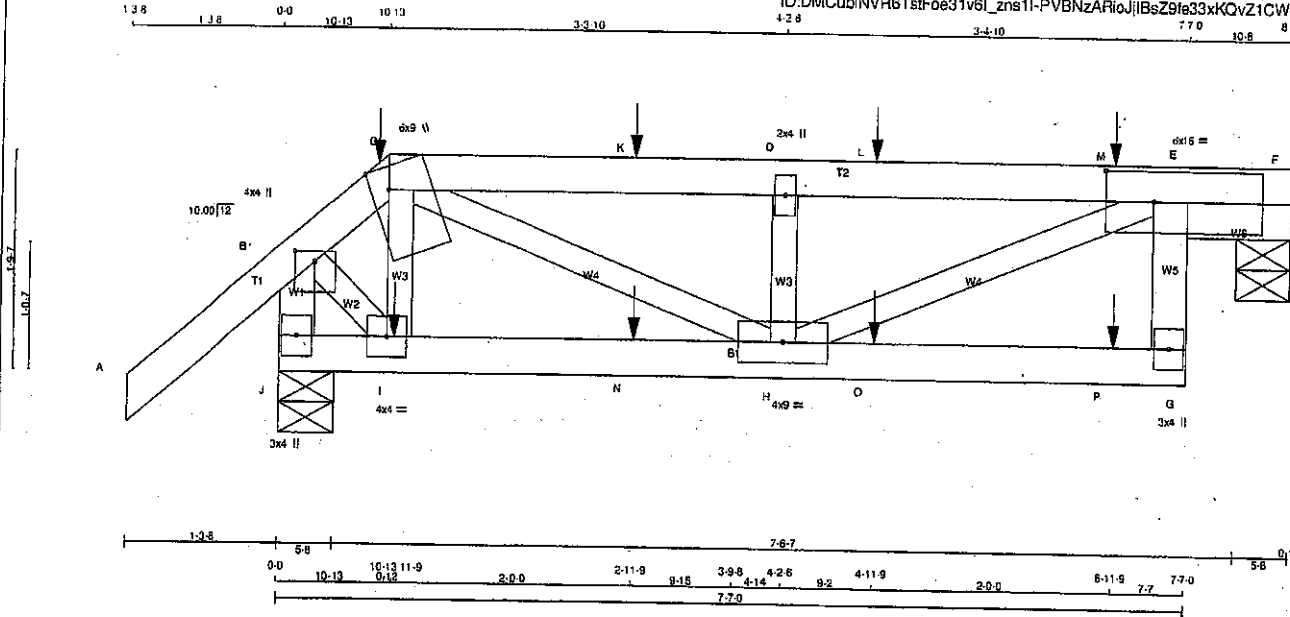

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
E - F	2x4	DRY	No.2
G - E	2x4	DRY	No.2
J - B	2x4	DRY	No.2
J - G	2x4	DRY	No.2

ALL WEBS 2x3 DRY
DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
C	TTWW+m	MT20	8.0	9.0	Edge 1.75
D	TMVW-w	MT20	2.0	4.0	
E	TMVWW-t	MT20	6.0	18.0	3.00 5.00
G	BMV+p	MT20	3.0	4.0	
H	BMVWW-t	MT20	4.0	9.0	
I	BMVW-t	MT20	4.0	4.0	
J	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED		MAXIMUM FACTORED		INPUT	REQD
	GROSS REACTION		GROSS REACTION		BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
F	695	0	895	0	0	5-8
J	936	0	936	0	0	5-8

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): F

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	490	327 / 0	0 / 0	0 / 0	0 / 0	163 / 0	0 / 0
J	659	449 / 0	0 / 0	0 / 0	0 / 0	210 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.56 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO				FR-TO			
A-B	0 / 41	-91.8	-91.8 0.14 (1)	10.00	I-C	-158 / 0	0.03 (1)
B-C	-856 / 0	-91.8	-91.8 0.14 (1)	6.25	B-I	0 / 548	0.14 (1)
C-K	-1230 / 0	-91.8	-91.8 0.46 (1)	5.09	H-D	-787 / 0	0.12 (1)
K-D	-1230 / 0	-91.8	-91.8 0.46 (1)	5.09	C-H	0 / 867	0.21 (1)
D-L	-1230 / 0	-91.8	-91.8 0.89 (1)	3.56	H-E	0 / 1345	0.33 (1)
L-M	-1230 / 0	-91.8	-91.8 0.89 (1)	3.56			
M-E	-1230 / 0	-91.8	-91.8 0.89 (1)	3.56			
E-F	0 / 0	-91.8	-91.8 0.35 (1)	10.00			
G-E	0 / 83	0.0	0.0 0.02 (4)	10.00			
J-B	-956 / 0	0.0	0.0 0.11 (1)	7.81			
J-I	0 / 0	-18.5	-18.5 0.06 (1)	10.00			
I-N	0 / 438	-18.5	-18.5 0.14 (1)	10.00			
N-H	0 / 438	-18.5	-18.5 0.14 (1)	10.00			
H-O	0 / 0	-18.5	-18.5 0.09 (1)	10.00			
O-P	0 / 0	-18.5	-18.5 0.09 (1)	10.00			
P-G	0 / 0	-18.5	-18.5 0.09 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	10-13	-9	-10	---	FRONT	VERT	DEAD	---	C1
C	10-13	-90	-90	---	FRONT	VERT	TOTAL	---	C1
C	10-13	-44	-44	---	FRONT	VERT	SNOW	---	C1
I	11-9	-49	-49	---	FRONT	VERT	TOTAL	---	C1
K	2-11-9	-82	-82	---	FRONT	VERT	TOTAL	---	C1
L	4-11-9	-82	-82	---	FRONT	VERT	TOTAL	---	C1
M	6-11-9	-82	-82	---	FRONT	VERT	TOTAL	---	C1
N	2-11-9	-49	-49	---	FRONT	VERT	TOTAL	---	C1
O	4-11-9	-49	-49	---	FRONT	VERT	TOTAL	---	C1
P	6-11-9	-53	-53	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 32 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL = 25.5	PSF
DL = 6.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD = 39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.25")
CALCULATED VERT. DEFL.(LL) = L/899 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (0.25")
CALCULATED VERT. DEFL.(TL) = L/898 (0.13")

CSI: TC=0.89/1.00 (D-E:1), BC=0.14/1.00 (H-I:1),
WB=0.33/1.00 (E-H:1), SSI=0.42/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 L8 BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.79 (C) (INPUT = 0.90)
JSI METAL = 0.30 (H) (INPUT = 1.00)




Structural component only
DWG# T-2007142

JOB NAME 408169	TRUSS NAME T20	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 12:49:24 2020 Page 1
ID:K7TPdgh0npl1qYdbWIOFzdeG-8Jggnst1sB7_Budbz0zKub486zN_xr0MZbH0gzNBDI
Scale = 1:37.5

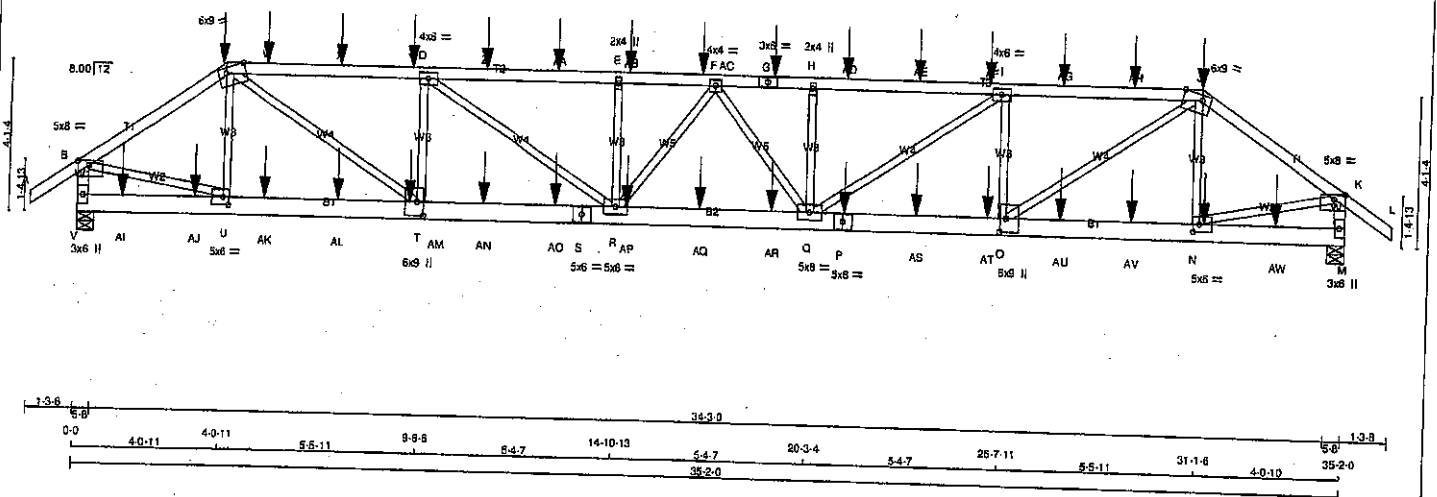

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	2x4	DRY	No.2
A - C	2x4	DRY	No.2
G - J	2x4	DRY	No.2
L - S	2x4	DRY	No.2
V - B	2x4	DRY	No.2
K - P	2x4	DRY	No.2
S - M	2x8	DRY	No.2
P - M	2x8	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
C 1	12	SIDE(81.0)
G 1	12	SIDE(81.0)
J 1	12	SIDE(81.0)
L 1	12	SIDE(81.0)
B 1	12	TOP
K 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
V 2	12	SIDE(183.1)
S 2	12	SIDE(183.1)
P 2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

Structural component only
DWG# T-2007145 1/2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER											
BEARINGS											
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG							
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX				
V	3342	0	3342	0	0	5-8	5-8				
M	3393	0	3393	0	0	5-8	5-8				
UNFACTORED REACTIONS											
JT	1ST LOASE	MAX. MIN. COMPONENT REACTIONS									
V	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL									
M	2363	1555 / 0 0 / 0 0 / 0 0 / 0 809 / 0 0 / 0									
	2397	1585 / 0 0 / 0 0 / 0 0 / 0 812 / 0 0 / 0									
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M											
BRACING											
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.03 FT.											
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.											
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.											
LOADING											
TOTAL LOAD CASES: (4)											
CHORDS											
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)			
FR-TO					FR-TO						
A-B	0 / 35	-91.8	-91.8 0.07 (1)	10.00	U-C	-596 / 0	0.05 (1)				
B-C	-3951 / 0	-91.8	-91.8 0.22 (1)	4.59	C-T	0 / 3530	0.44 (1)				
C-W	-6186 / 0	-91.8	-91.8 0.81 (1)	3.41	T-D	-1829 / 0	0.23 (1)				
W-X	-6186 / 0	-91.8	-91.8 0.81 (1)	3.41	D-R	0 / 1602	0.20 (1)				
X-Y	-6186 / 0	-91.8	-91.8 0.81 (1)	3.41	R-E	-602 / 0	0.08 (1)				
Y-D	-6186 / 0	-91.8	-91.8 0.81 (1)	3.41	Q-H	-596 / 0	0.08 (1)				
D-Z	-7502 / 0	-91.8	-91.8 0.71 (1)	3.03	Q-I	0 / 1573	0.19 (1)				
Z-AA	-7502 / 0	-91.8	-91.8 0.71 (1)	3.03	D-I	-1806 / 0	0.23 (1)				
AA-E	-7502 / 0	-91.8	-91.8 0.71 (1)	3.03	C-J	0 / 3493	0.43 (1)				
E-AB	-7502 / 0	-91.8	-91.8 0.35 (1)	3.03	N-J	-815 / 0	0.08 (1)				
AB-AC	-7502 / 0	-91.8	-91.8 0.35 (1)	3.03	B-U	0 / 3374	0.42 (1)				
AC-F	-7502 / 0	-91.8	-91.8 0.35 (1)	3.03	N-K	0 / 3438	0.43 (1)				
F-G	-7509 / 0	-91.8	-91.8 0.37 (1)	3.31	R-F	-179 / 0	0.03 (1)				
G-H	-7509 / 0	-91.8	-91.8 0.37 (1)	3.31	F-Q	-166 / 0	0.03 (1)				
H-AD	-7509 / 0	-91.8	-91.8 0.71 (1)	3.03							
AD-AE	-7509 / 0	-91.8	-91.8 0.71 (1)	3.03							
AE-AF	-7509 / 0	-91.8	-91.8 0.71 (1)	3.03							
AF-I	-7509 / 0	-91.8	-91.8 0.71 (1)	3.03							
I-AG	-8217 / 0	-91.8	-91.8 0.81 (1)	3.41							
AG-AH	-8217 / 0	-91.8	-91.8 0.81 (1)	3.41							
AH-J	-8217 / 0	-91.8	-91.8 0.81 (1)	3.41							
J-K	-4025 / 0	-91.8	-91.8 0.22 (1)	4.55							
K-L	0 / 35	-91.8	-91.8 0.07 (1)	10.00							
V-B	-3288 / 0	0.0	0.0 0.18 (1)	5.41							
M-K	-3356 / 0	0.0	0.0 0.19 (1)	6.38							
V-AI	0 / 0	-18.5	-18.5 0.05 (4)	10.00							
AH-AJ	0 / 0	-18.5	-18.5 0.05 (4)	10.00							
AJ-U	0 / 0	-18.5	-18.5 0.05 (4)	10.00							
U-AK	0 / 3265	-18.5	-18.5 0.25 (1)	10.00							
AK-AL	0 / 3265	-18.5	-18.5 0.25 (1)	10.00							
AL-AM	0 / 3265	-18.5	-18.5 0.25 (1)	10.00							
AM-T	0 / 3265	-18.5	-18.5 0.25 (1)	10.00							
T-AN	0 / 6186	-18.5	-18.5 0.48 (1)	10.00							
AN-AO	0 / 6186	-18.5	-18.5 0.48 (1)	10.00							
AO-S	0 / 6186	-18.5	-18.5 0.48 (1)	10.00							
S-R	0 / 6186	-18.5	-18.5 0.48 (1)	10.00							
R-AP	0 / 7808	-18.5	-18.5 0.56 (1)	10.00							
AP-AQ	0 / 7808	-18.5	-18.5 0.56 (1)	10.00							
AQ-AR	0 / 7808	-18.5	-18.5 0.56 (1)	10.00							
AR-Q	0 / 7808	-18.5	-18.5 0.56 (1)	10.00							
Q-P	0 / 8217	-18.5	-18.5 0.46 (1)	10.00							
P-AS	0 / 8217	-18.5	-18.5 0.46 (1)	10.00							

TOTAL WEIGHT = 2 X 160 = 321 lb											
DESIGN CRITERIA											
*** SPECIAL LOADS ANALYSIS ***											
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.											
LOADS WERE DERIVED FROM USER INPUT											
NO FURTHER MODIFICATIONS WERE MADE											
SPECIFIED LOADS:											
TOP CH.	LL	=	25.6	PSF							
	DL	=	6.0	PSF							
BOT CH.	LL	=	0.0	PSF							
	DL	=	7.4	PSF							
TOTAL LOAD	=	39.0	PSF								
SPACING = 24.0 IN. C/C											
LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12											
*** NON STANDARD GIRDER ***											
ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.											
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015											
THIS DESIGN COMPLIES WITH:											
- PART 9 OF CBC 2018, CBC 2012, ABC 2019											
- PART 9 OF OBC 2012 (2019 AMENDMENT)											
- CSA 086-09, CSA 086-14											
- TPIC 2011, TPIC 2014											
(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD											
ALLOWABLE DEFL.(LL) = L/360 (1.17")											
CALCULATED VERT. DEFL.(LL) = L/999 (0.23")											
ALLOWABLE DEFL.(TL) = L/360 (1.17")											
CALCULATED VERT. DEFL.(TL) = L/964 (0.44")											
CSI: TC=0.71/1.00 (D-E:1), BC=0.58/1.00 (Q-R:1), WB=0.44/1.00 (C-T:1), SS=0.23/1.00 (C-D:1)											
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00											
COMPANION LIVE LOAD FACTOR = 1.00											
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.											
NAIL VALUES											
PLATE GRIP(DRY)	SHEAR SECTION										
(PSI)	(PLI)	(PLI)									
MAX MIN	MAX MIN	MAX MIN									
MT20	618	354	1667	788	1987	1666					
PLATE PLACEMENT TOL. = 0.250 inches											
PLATE ROTATION TOL. = 5.0 Deg.											
JSI GRIP= 0.71 (G) (INPUT = 0.90)											
JSI METAL= 0.59 (S) (INPUT = 1.00)											



Structural component only
DWG# T-2007145 1/2

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.50	3.50
C	TTWW-m	MT20	6.0	9.0	Edge	6.25
D	TMWW-t	MT20	4.0	6.0		
E	TMW-w	MT20	2.0	4.0		
F	TMWW-t	MT20	4.0	4.0		
G	TS-t	MT20	3.0	6.0		
H	TMW-w	MT20	2.0	4.0		
I	TMWW-t	MT20	4.0	6.0		
J	TTWW-m	MT20	8.0	9.0	Edge	6.25
K	TMVW-p	MT20	5.0	8.0	1.50	3.50
M	BMV1-p	MT20	3.0	6.0		
N	BMWW-t	MT20	5.0	6.0	2.50	2.00
O	BMWW-t	MT20	8.0	9.0	4.50	2.00
P	BS-t	MT20	5.0	8.0		
Q	BMWWW-t	MT20	5.0	8.0		
R	BMWWW-t	MT20	5.0	8.0		
S	BS-t	MT20	5.0	8.0		
T	BMWW-t	MT20	6.0	9.0	4.50	2.00
U	BMWW-t	MT20	5.0	6.0	2.50	2.00
V	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (LBS)	MAX. FACTORED (FLF) CSI (LC)	MAX. UNBRAC LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO							
AS-AT	0 / 6217	-18.5	-18.5 0.46 (1)	10.00			
AT-O	0 / 6217	-18.5	-18.5 0.46 (1)	10.00			
O-AU	0 / 3326	-18.5	-18.5 0.26 (1)	10.00			
AU-AV	0 / 3326	-18.5	-18.5 0.26 (1)	10.00			
AV-N	0 / 3326	-18.5	-18.5 0.26 (1)	10.00			
N-AW	0 / 0	-18.5	-18.5 0.04 (4)	10.00			
AW-M	0 / 0	-18.5	-18.5 0.04 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-11	-49	-55		FRONT	VERT	DEAD		C1
C	4-0-11	-254	-254		FRONT	VERT	SNOW		C1
G	19-2-12	-110	-110		BACK	VERT	TOTAL		C1
J	31-1-6	-49	-55		FRONT	VERT	DEAD		C1
J	31-1-6	-117	-117		BACK	VERT	TOTAL		C1
N	31-1-6	-254	-254		FRONT	VERT	SNOW		C1
P	31-2-12	-26	-26		BACK	VERT	TOTAL		C1
W	21-2-12	-26	-26		BACK	VERT	TOTAL		C1
X	7-2-12	-110	-110		BACK	VERT	TOTAL		C1
Y	7-2-12	-110	-110		BACK	VERT	TOTAL		C1
Z	11-2-12	-110	-110		BACK	VERT	TOTAL		C1
AA	13-2-12	-110	-110		BACK	VERT	TOTAL		C1
AB	15-2-12	-110	-110		BACK	VERT	TOTAL		C1
AC	17-2-12	-110	-110		BACK	VERT	TOTAL		C1
AD	21-2-12	-110	-110		BACK	VERT	TOTAL		C1
AE	23-2-12	-110	-110		BACK	VERT	TOTAL		C1
AF	25-2-12	-110	-110		BACK	VERT	TOTAL		C1
AG	27-2-12	-110	-110		BACK	VERT	TOTAL		C1
AH	29-2-12	-110	-110		BACK	VERT	TOTAL		C1
AI	1-2-12	-26	-26		BACK	VERT	TOTAL		C1
AJ	3-2-12	-26	-26		BACK	VERT	TOTAL		C1
AK	5-2-12	-26	-26		BACK	VERT	TOTAL		C1
AL	7-2-12	-26	-26		BACK	VERT	TOTAL		C1
AM	9-2-12	-26	-26		BACK	VERT	TOTAL		C1
AN	11-2-12	-26	-26		BACK	VERT	TOTAL		C1
AO	13-2-12	-26	-26		BACK	VERT	TOTAL		C1
AP	15-2-12	-26	-26		BACK	VERT	TOTAL		C1
AQ	17-2-12	-26	-26		BACK	VERT	TOTAL		C1
AR	19-2-12	-26	-26		BACK	VERT	TOTAL		C1
AS	23-2-12	-26	-26		BACK	VERT	TOTAL		C1
AT	25-2-12	-26	-26		BACK	VERT	TOTAL		C1
AU	27-2-12	-26	-26		BACK	VERT	TOTAL		C1
AV	29-2-12	-26	-26		BACK	VERT	TOTAL		C1
AW	33-2-12	-26	-26		BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007145


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408169	T20Z	1	2	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:48:25 2020 Page 1

ID:K?TPdHgJ0npl1qYdbWfOfzdeG-AKHFWtPo9K_cKTP9gXCt67DKWF2jK9bCKQw7zNBDe

Scale = 1:57.3

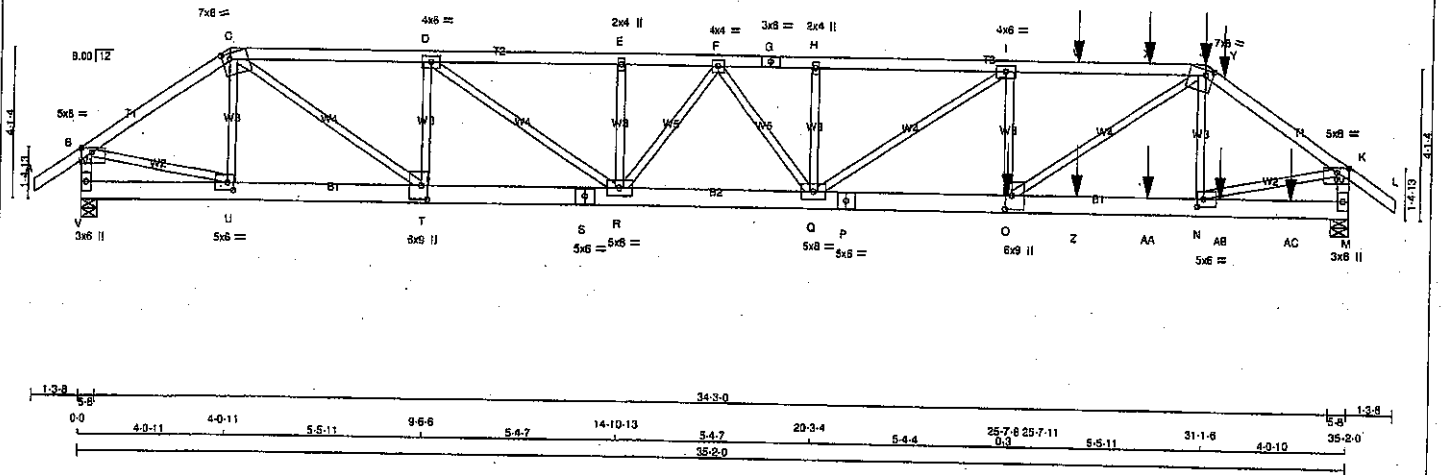

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - G	2x4	DRY	No.2	SPF		
G - J	2x4	DRY	No.2	SPF		
J - L	2x4	DRY	No.2	SPF		
V - B	2x4	DRY	No.2	SPF		
M - K	2x4	DRY	No.2	SPF		
V - S	2x6	DRY	No.2	SPF		
S - P	2x6	DRY	No.2	SPF		
P - M	2x6	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	12	TOP
C-G	12	TOP
G-J	12	SIDE(61.0)
J-L	12	SIDE(61.0)
V-B	12	TOP
M-K	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
V-S	12	TOP
S-P	12	TOP
P-M	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	SIDE(557.3)
I-O	3	
D-T	3	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	5-8	5-8
V	HORZ	HORZ	5-8	5-8
M			5-8	5-8

UNFACTORED REACTIONS

1ST LOSE	MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
V	2073	1388 / 0	0 / 0	0 / 0	0 / 0	684 / 0
M	3391	2278 / 0	0 / 0	0 / 0	0 / 0	1103 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.57 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)
FR-TO									
A-B	0 / 35	-91.8	-91.8	0.07 (1)	10.00	U-C	-564 / 0	0.07 (1)	
B-C	-3442 / 0	-91.8	-91.8	0.20 (1)	4.86	C-T	0 / 3700	0.46 (1)	
C-D	-5905 / 0	-91.8	-91.8	0.43 (1)	3.70	T-D	-1983 / 0	0.25 (1)	
D-E	-7947 / 0	-91.8	-91.8	0.58 (1)	3.11	D-R	0 / 2485	0.31 (1)	
E-F	-7947 / 0	-91.8	-91.8	0.31 (1)	3.30	R-E	-368 / 0	0.05 (1)	
F-G	-9222 / 0	-91.8	-91.8	0.38 (1)	3.01	Q-H	-346 / 0	0.04 (1)	
G-H	-9222 / 0	-91.8	-91.8	0.38 (1)	3.01	Q-I	-509 / 0	0.19 (1)	
H-I	-9222 / 0	-91.8	-91.8	0.77 (1)	2.73	Q-J	-397 / 0	0.05 (1)	
I-W	-9535 / 0	-91.8	-91.8	0.88 (1)	2.57	Q-J	0 / 5776	0.71 (1)	
W-X	-9535 / 0	-91.8	-91.8	0.88 (1)	2.57	N-J	-915 / 0	0.12 (1)	
X-Y	-9535 / 0	-91.8	-91.8	0.88 (1)	2.57	B-U	0 / 2940	0.36 (1)	
J-Y	-5847 / 0	-91.8	-91.8	0.33 (1)	3.78	N-K	0 / 5020	0.62 (1)	
Y-K	-5847 / 0	-91.8	-91.8	0.33 (1)	3.78	R-F	-1209 / 0	0.21 (1)	
K-L	0 / 35	-91.8	-91.8	0.07 (1)	10.00	F-Q	0 / 974	0.12 (1)	
V-B	-2914 / 0	0.0	0.0	0.16 (1)	8.74				
M-K	-4771 / 0	0.0	0.0	0.27 (1)	5.48				
V-U	0 / 0	-18.5	-18.5	0.03 (4)	10.00				
U-T	0 / 2843	-18.5	-18.5	0.21 (1)	10.00				
T-S	0 / 5906	-18.5	-18.5	0.44 (1)	10.00				
S-R	0 / 5906	-18.5	-18.5	0.44 (1)	10.00				
R-Q	0 / 8653	-18.5	-18.5	0.82 (1)	10.00				
Q-P	0 / 8653	-18.5	-18.5	0.72 (1)	10.00				
P-O	0 / 8653	-18.5	-18.5	0.72 (1)	10.00				
O-Z	0 / 4855	-18.5	-18.5	0.41 (1)	10.00				
Z-AA	0 / 4855	-18.5	-18.5	0.41 (1)	10.00				
AA-N	0 / 4855	-18.5	-18.5	0.41 (1)	10.00				
N-AB	0 / 0	-18.5	-18.5	0.06 (4)	10.00				
AB-AC	0 / 0	-18.5	-18.5	0.06 (4)	10.00				
AC-M	0 / 0	-18.5	-18.5	0.06 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
J	31-1-6	-49	-55	FRONT	VERT	DEAD		C1
J	31-1-6	-254	-254	FRONT	VERT	SNOW		C1
O	25-7-8	-2840	-2840	FRONT	VERT	TOTAL		C1
W	27-8-12	-110	-110	FRONT	VERT	TOTAL		C1
X	29-6-12	-110	-110	FRONT	VERT	TOTAL		C1
Y	31-6-12	-136	-136	FRONT	VERT	TOTAL		C1
Z	27-8-12	-26	-26	FRONT	VERT	TOTAL		C1
AA	29-6-12	-26	-26	FRONT	VERT	TOTAL		C1
AB	31-6-12	-26	-26	FRONT	VERT	TOTAL		C1
AC	33-6-12	-26	-26	FRONT	VERT	TOTAL		C1

TOTAL WEIGHT = 2 X 160 = 321 LB

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***
ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2015, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.28")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/932 (0.51")

CSI: TC=0.88/1.00 (I-J-1), BC=0.72/1.00 (O-Q-1),
WB=0.71/1.00 (J-O-1), SS=0.18/1.00 (I-J-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (C) (INPUT = 0.90)
JSI METAL= 0.87 (S) (INPUT = 1.00)

CONTINUED ON PAGE 2



Structural component only
DWG# T-2007146 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T20Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Sat Apr 25 12:49:25 2020 Page 2
ID:K?TPdhq[0np!1qYdbWlOFzIdeG-AKHFWtPq9K cKTP9qXCi87DKWF2Jk9bCKqW7zNBDe

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.50	3.50
C	TTWW-m	MT20	7.0	8.0	1.75	2.50
D	TMWW-l	MT20	4.0	6.0		
E	TMW-w	MT20	2.0	4.0		
F	TMWW-t	MT20	4.0	4.0		
G	TS-l	MT20	3.0	6.0		
H	TMW-w	MT20	2.0	4.0		
I	TMWW-t	MT20	4.0	6.0		
J	TTWW-m	MT20	7.0	8.0	1.75	2.50
K	TMVW-p	MT20	5.0	8.0	1.50	3.50
M	BMV1-p	MT20	3.0	6.0		
N	BMWW-l	MT20	5.0	6.0	2.50	2.00
O	BMWW-t	MT20	6.0	9.0	4.50	2.00
P	BS-l	MT20	5.0	8.0		
Q	BMWWW-l	MT20	5.0	8.0		
R	BMWWW-t	MT20	5.0	8.0		
S	BS-l	MT20	5.0	6.0		
T	BMWW-t	MT20	6.0	9.0	4.50	2.00
U	BMWW-l	MT20	5.0	6.0	2.50	2.00
V	BMV1-p	MT20	3.0	6.0		

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007146 32

JOB NAME 408169	TRUSS NAME T21	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:26 2020 Page 1
ID:K7TPdhgJnpl1qIYdbWfOfzIdaG-eWrd5G2ZTSrDU10jO2RPJgONwdaSrJps4OSZzNB0d

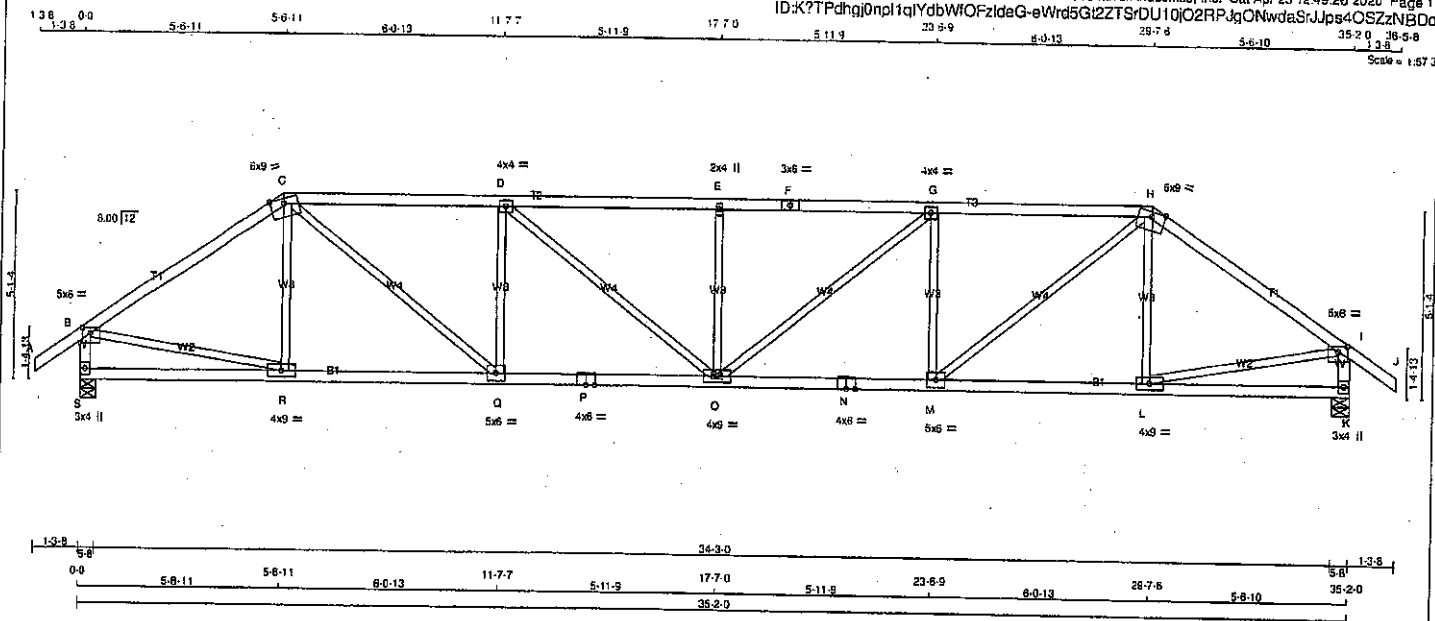

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
S - P	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TMVW-m	MT20	8.0	9.0	Edge	
D	TMVW-i	MT20	4.0	4.0		
E	TMVW-w	MT20	2.0	4.0		
F	TS-i	MT20	3.0	6.0		
G	TMVW-i	MT20	4.0	4.0		
H	TMVW-m	MT20	6.0	9.0	Edge	
I	TMVW-p	MT20	5.0	6.0	1.75	2.75
K	BMV1-p	MT20	3.0	4.0		
L	BMVW-i	MT20	4.0	9.0		
M	BMVW-i	MT20	5.0	6.0		
N	BS-i	MT20	4.0	9.0		
O	BMVW-i	MT20	4.0	9.0		
P	BS-i	MT20	4.0	9.0		
Q	BMVW-i	MT20	5.0	6.0		
R	BMVW-i	MT20	4.0	9.0		
S	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	0	5-8
S	HORZ	UP	0	5-8
K	VERT	DOWN	0	5-8

UNFACTORED REACTIONS

1ST LOASE	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
S	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
K	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)
FR-TO						FR-TO			
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	R-C	-243 / 10	0.09 (1)	
B-C	-2297 / 0	-91.8	-91.8	0.70 (1)	3.78	C-Q	0 / 1869	0.38 (1)	
C-D	-3213 / 0	-91.8	-91.8	0.80 (1)	3.19	Q-D	-929 / 0	0.36 (1)	
D-E	-3594 / 0	-91.8	-91.8	0.86 (1)	2.97	D-O	0 / 489	0.11 (1)	
E-F	-3594 / 0	-91.8	-91.8	0.86 (1)	2.97	O-E	-506 / 0	0.19 (1)	
F-G	-3594 / 0	-91.8	-91.8	0.86 (1)	2.97	G-G	0 / 490	0.11 (1)	
G-H	-3213 / 0	-91.8	-91.8	0.80 (1)	3.19	M-H	-929 / 0	0.36 (1)	
H-I	-2296 / 0	-91.8	-91.8	0.70 (1)	3.78	M-H	0 / 1670	0.38 (1)	
I-J	0 / 35	-91.8	-91.8	0.12 (1)	10.00	L-H	-243 / 10	0.09 (1)	
S-B	-2023 / 0	0.0	0.0	0.21 (1)	5.94	B-R	0 / 1943	0.44 (1)	
K-I	-2023 / 0	0.0	0.0	0.21 (1)	5.94	L-I	0 / 1943	0.44 (1)	
S-R	0 / 0	-18.5	-18.5	0.15 (4)	10.00				
R-Q	0 / 1904	-18.5	-18.5	0.39 (1)	10.00				
Q-P	0 / 3213	-18.5	-18.5	0.59 (1)	10.00				
P-O	0 / 3213	-18.5	-18.5	0.59 (1)	10.00				
O-N	0 / 3213	-18.5	-18.5	0.59 (1)	10.00				
N-M	0 / 3213	-18.5	-18.5	0.59 (1)	10.00				
M-L	0 / 1903	-18.5	-18.5	0.39 (1)	10.00				
L-K	0 / 0	-18.5	-18.5	0.15 (4)	10.00				

TOTAL WEIGHT = 2 X 140 = 280 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.21")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.39")

CSI: TC=0.89/1.00 (E-G-1), BC=0.58/1.00 (O-Q-1),
WB=0.44/1.00 (B-R-1), SSI=0.26/1.00 (G-H-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1587 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (B) (INPUT = 0.90)
JSI METAL = 0.74 (P) (INPUT = 1.00)

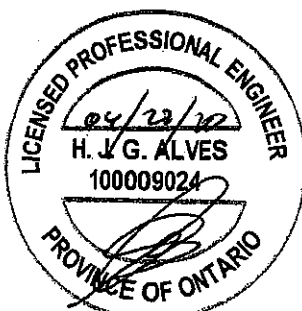

Structural component only
DWG# T-2007147

JOB NAME 408169	TRUSS NAME T22	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:49:27 2020 Page 1					
ID:K?TPdchg0npl1qYdbWIOFzIdeG-5jO?JbugKnairecCH5ZgyXDemJ?DB9HS2Wpx??zNBDC					

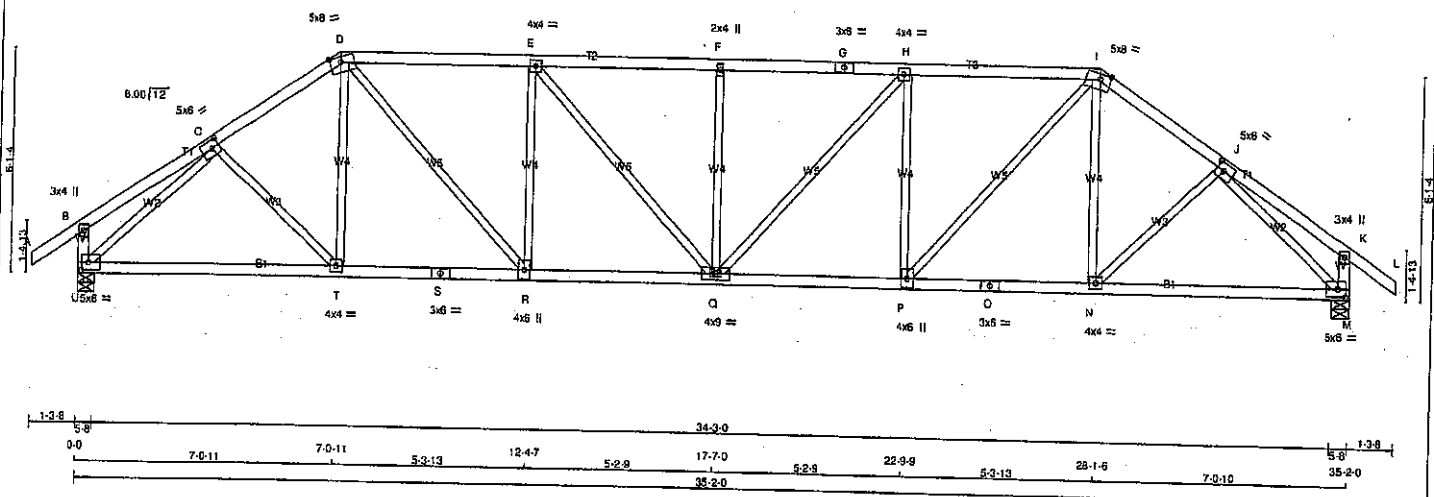

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
U - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
U - S	2x4	DRY	No.2
S - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMV+p	MT20	3.0	4.0	
C TMWV+I	MT20	5.0	8.0	2.50 2.50
D ITWW+m	MT20	5.0	8.0	1.75 3.50
E TMWV+I	MT20	4.0	4.0	
F TMW+V	MT20	2.0	4.0	
G TS+I	MT20	3.0	6.0	
H TMWV+I	MT20	4.0	4.0	
I ITWW+m	MT20	5.0	8.0	1.75 3.50
J TMWV+I	MT20	5.0	8.0	2.50 2.50
K TMV+p	MT20	3.0	4.0	
M BMWV+I	MT20	5.0	8.0	2.50 2.25
N BMWV+I	MT20	4.0	4.0	
O BS+I	MT20	3.0	6.0	
P BMWV+I	MT20	4.0	4.0	
Q BMWV+I	MT20	4.0	4.0	
R BMWV+I	MT20	4.0	4.0	
S BS+I	MT20	3.0	6.0	
T BMWV+I	MT20	4.0	4.0	
U BMWV+I	MT20	5.0	8.0	2.50 2.25

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
JT	FACTORED GROSS REACTION	VERT	HORZ	MAXIMUM FACTORED GROSS REACTION	VERT	HORZ	INPUT BRG UPLIFT	REQD BRG IN-SX	REQD BRG IN-SX
U	2065	0	0	2065	0	0	5-8	5-8	5-8
M	2065	0	0	2065	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
U	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
M	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.53 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS									
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED HORZ. LOAD (LBS)	MAX. LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED HORZ. LOAD (LBS)	MAX. LENGTH (FT)
FR-TO		FROM	TO		FR-TO		FROM	TO	
A-B	0 / 135	-91.8	-91.8	0.12 (1)	10.00	C-T	0 / 135	0.03 (4)	10.00
B-C	0 / 18	-91.8	-91.8	0.15 (1)	10.00	T-D	0 / 90	0.03 (4)	10.00
C-D	-2305 / 0	-91.8	-91.8	0.23 (1)	4.31	D-R	0 / 1218	0.27 (1)	10.00
D-E	2723 / 0	-91.8	-91.8	0.54 (1)	3.69	R-E	-814 / 0	0.48 (1)	10.00
E-F	2856 / 0	-91.8	-91.8	0.55 (1)	3.53	E-Q	0 / 363	0.08 (1)	10.00
F-G	-2866 / 0	-91.8	-91.8	0.55 (1)	3.53	Q-F	-440 / 0	0.26 (1)	10.00
G-H	-2866 / 0	-91.8	-91.8	0.55 (1)	3.53	H-Q	0 / 363	0.08 (1)	10.00
H-I	-2723 / 0	-91.8	-91.8	0.54 (1)	3.69	P-H	-814 / 0	0.48 (1)	10.00
I-J	-2305 / 0	-91.8	-91.8	0.23 (1)	4.31	P-I	0 / 1218	0.27 (1)	10.00
J-K	0 / 18	-91.8	-91.8	0.15 (1)	10.00	N-I	0 / 90	0.03 (4)	10.00
K-L	0 / 35	-91.8	-91.8	0.12 (1)	10.00	N-J	0 / 136	0.03 (4)	10.00
U-B	-255 / 0	0.0	0.0	0.03 (1)	7.81	U-C	-2515 / 0	0.97 (1)	10.00
M-K	-255 / 0	0.0	0.0	0.03 (1)	7.81	J-M	-2514 / 0	0.97 (1)	10.00
U-T	0 / 1802	-18.5	-18.5	0.40 (1)	10.00				
T-S	0 / 1901	-18.5	-18.5	0.41 (1)	10.00				
S-R	0 / 1901	-18.5	-18.5	0.41 (1)	10.00				
R-Q	0 / 2724	-18.5	-18.5	0.49 (1)	10.00				
Q-P	0 / 2723	-18.5	-18.5	0.49 (1)	10.00				
P-O	0 / 1900	-18.5	-18.5	0.41 (1)	10.00				
O-N	0 / 1900	-18.5	-18.5	0.41 (1)	10.00				
N-M	0 / 1801	-18.5	-18.5	0.40 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")

CALCULATED VERT. DEFL.(LL) = L/999 (0.18")

ALLOWABLE DEFL.(TL) = L/360 (1.17")

CALCULATED VERT. DEFL.(TL) = L/999 (0.29")

CSL TC=0.56/1.00 (E-F:1), BC=0.49/1.00 (G-R:1), WB=0.97/1.00 (C-U:1), SS=0.23/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (M) (INPUT = 0.90)


JSI METAL = 0.63 (C) (INPUT = 1.00)

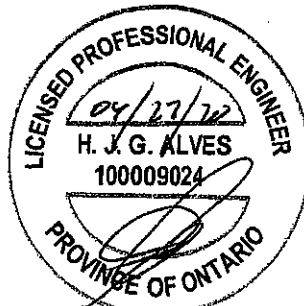

Structural component only
DWG# T-2007148

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T23	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.316 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:28 2020 Page 1
ID:K?TPdhgiOnp1qYdbWfOfzIdG-bvY/NWxv154IZtBOqp4vVkiEjLmwjVbHAZVXRzNBOb

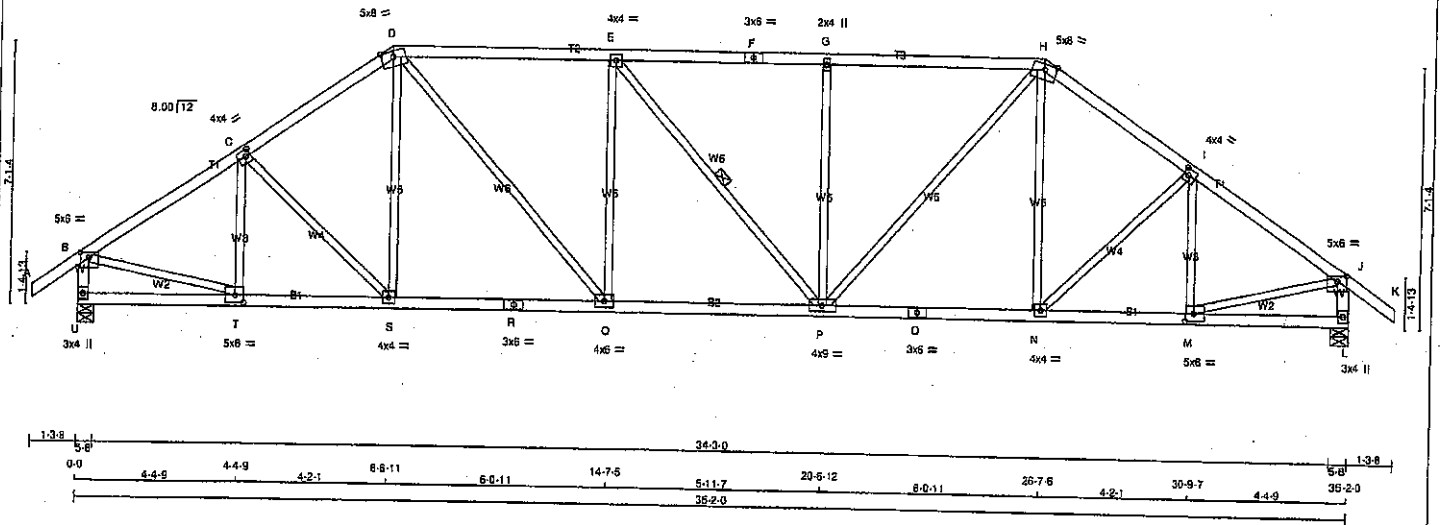

CHORDS	SIZE	LUMBER
A - D	2x4	DRY No.2
D - F	2x4	DRY No.2
F - H	2x4	DRY No.2
H - K	2x4	DRY No.2
U - B	2x4	DRY No.2
L - J	2x4	DRY No.2
U - R	2x4	DRY No.2
R - O	2x4	DRY No.2
O - L	2x4	DRY No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMW-p	MT20	5.0	6.0	1.75	2.75
C TMW-w	MT20	4.0	4.0	2.00	1.50
D TMW-m	MT20	5.0	8.0	Edge	
E TMW-w	MT20	4.0	4.0		
F TS-t	MT20	3.0	6.0		
G TMW-w	MT20	2.0	4.0		
H TMW-m	MT20	5.0	8.0	Edge	
I TMW-w	MT20	4.0	4.0	2.00	1.50
J TMW-p	MT20	5.0	6.0	1.75	2.75
L BMV1-p	MT20	3.0	4.0		
M BMW-w	MT20	5.0	6.0	2.50	2.75
N BMW-w	MT20	4.0	4.0		
O BS-t	MT20	3.0	6.0		
P BMW-w	MT20	4.0	4.0		
Q BMW-w	MT20	4.0	6.0		
R BS-t	MT20	3.0	6.0		
S BMW-w	MT20	4.0	4.0		
T BMW-w	MT20	5.0	6.0	2.50	2.75
U BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECRD BRG
JT VERT	2065	0	2065	0
U	2065	0	2065	0
L	2065	0	2065	0

UNFACTORED REACTIONS

1ST LOASE	MAX/MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM LIVE WIND DEAD SOIL
U	1458 970 / 0 0 / 0 0 / 0 488 / 0 0 / 0
L	1458 970 / 0 0 / 0 0 / 0 488 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (LBS)	FACTORED (PLF)	MAX. (CSI (LC))	MAX. (CSI (LC))	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. (CSI (LC))
FR-TO	FR-TO	FR-TO	FR-TO	FR-TO	FR-TO	FR-TO	FR-TO	FR-TO	FR-TO	FR-TO
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	10.00	T-C	-396 / 0	0.11 (1)	0.11 (1)
B-C	-2270 / 0	-91.8	-91.8	0.37 (1)	4.19	4.19	C-S	-79 / 0	0.05 (1)	0.05 (1)
C-D	-2254 / 0	-91.8	-91.8	0.38 (1)	4.21	4.21	S-D	0 / 156	0.04 (4)	0.04 (4)
D-E	-2485 / 0	-91.8	-91.8	0.84 (1)	3.72	3.72	D-Q	0 / 949	0.21 (1)	0.21 (1)
E-F	-2483 / 0	-91.8	-91.8	0.84 (1)	3.72	3.72	Q-E	-597 / 0	0.52 (1)	0.52 (1)
F-G	-2483 / 0	-91.8	-91.8	0.84 (1)	3.72	3.72	E-P	-2 / 0	0.00 (1)	0.00 (1)
G-H	-2483 / 0	-91.8	-91.8	0.84 (1)	3.72	3.72	P-G	-596 / 0	0.52 (1)	0.52 (1)
H-I	-2254 / 0	-91.8	-91.8	0.38 (1)	4.21	4.21	P-H	0 / 947	0.21 (1)	0.21 (1)
I-J	-2269 / 0	-91.8	-91.8	0.37 (1)	4.19	4.19	H-N	0 / 157	0.04 (4)	0.04 (4)
J-K	0 / 35	-91.8	-91.8	0.12 (1)	10.00	10.00	N-I	-78 / 0	0.05 (1)	0.05 (1)
U-B	-2027 / 0	0.0	0.0	0.21 (1)	5.94	5.94	M-I	-397 / 0	0.11 (1)	0.11 (1)
L-J	-2026 / 0	0.0	0.0	0.21 (1)	5.94	5.94	B-T	0 / 1866	0.44 (1)	0.44 (1)
U-T	0 / 0	-18.5	-18.5	0.08 (4)	10.00	10.00	M-J	0 / 1965	0.44 (1)	0.44 (1)
T-S	0 / 1909	-18.5	-18.5	0.37 (1)	10.00	10.00				
S-R	0 / 1854	-18.5	-18.5	0.36 (1)	10.00	10.00				
R-Q	0 / 1854	-18.5	-18.5	0.36 (1)	10.00	10.00				
Q-P	0 / 2485	-18.5	-18.5	0.47 (1)	10.00	10.00				
P-O	0 / 1854	-18.5	-18.5	0.36 (1)	10.00	10.00				
O-N	0 / 1854	-18.5	-18.5	0.36 (1)	10.00	10.00				
N-M	0 / 1909	-18.5	-18.5	0.37 (1)	10.00	10.00				
M-L	0 / 0	-18.5	-18.5	0.08 (4)	10.00	10.00				

TOTAL WEIGHT = 2 X 155 = 309 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.64/1.00 (D-E:1), BC=0.47/1.00 (P-Q:1),
WB=0.52/1.00 (E-Q:1), SSI=0.29/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.90 (O) (INPUT = 0.90)
JSI METAL= 0.62 (O) (INPUT = 1.00)

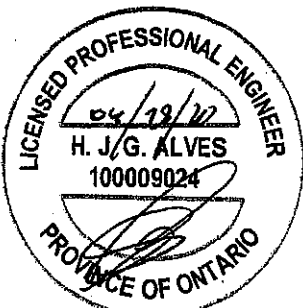


Structural component only
DWG# T-2007149

JOB NAME 408169	TRUSS NAME T24	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Pool Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:29 2020 Page 1
ID:K7TPdhgi0npl1qYdbWIOFzdeG-35WmkHwvsOqQ4ymbOWc81yiwH7mfBIWql23uzNBda

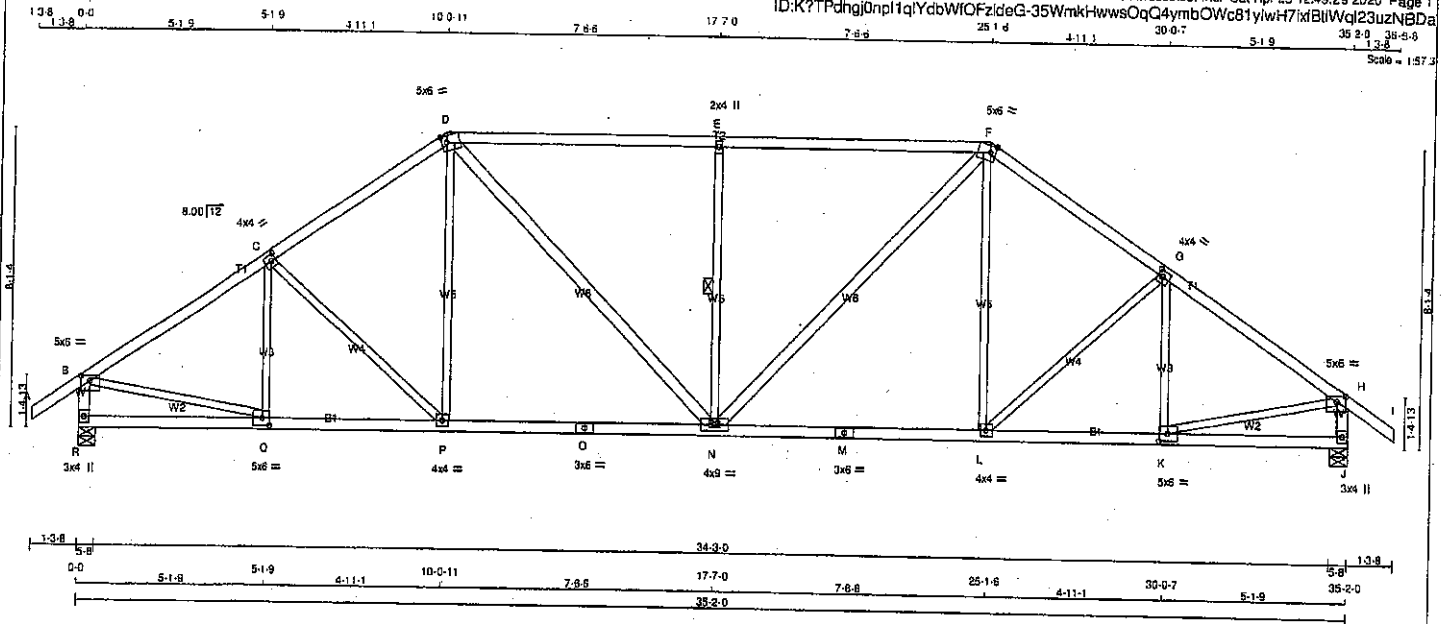

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - B	2x4	DRY	No.2
B - H	2x4	DRY	No.2
H - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2

ALL WEBS EXCEPT	2x3	DRY	No.2
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	5.0	1.75	2.75
C	TMVW-w	MT20	4.0	4.0	2.00	1.50
D	TMVW-m	MT20	5.0	5.0	2.25	1.75
E	TMVW-w	MT20	2.0	4.0		
F	TMVW-m	MT20	5.0	5.0	2.25	1.75
G	TMVW-w	MT20	4.0	4.0	2.00	1.50
H	TMVW-p	MT20	5.0	5.0	1.75	2.75
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-t	MT20	5.0	5.0	2.50	2.75
L	BS-t	MT20	4.0	4.0		
N	BS-t	MT20	3.0	5.0		
O	BS-t	MT20	4.0	5.0		
P	BS-t	MT20	3.0	5.0		
Q	BS-t	MT20	4.0	5.0		
R	BMV1-p	MT20	5.0	5.0	2.50	2.75

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	DOWN	IN-SX	IN-SX
R	2065	0	5-8	5-8
J	2065	0	5-8	5-8

UNFACTORED REACTIONS

	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
J	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
FR-TO		FROM - TO		FR-TO			
A-B	0 / 35	-91.8 -91.8	0.12 (1)	10.00	Q-C	-321 / 0	0.11 (1)
B-C	-2318 / 0	-91.8 -91.8	0.38 (1)	4.16	C-P	-218 / 0	0.18 (1)
C-D	-2198 / 0	-91.8 -91.8	0.37 (1)	4.28	P-D	0 / 266	0.08 (1)
D-E	-2274 / 0	-91.8 -91.8	0.81 (1)	3.47	D-N	0 / 691	0.11 (1)
E-F	-2274 / 0	-91.8 -91.8	0.81 (1)	3.47	N-E	-851 / 0	0.35 (1)
F-G	-2185 / 0	-91.8 -91.8	0.37 (1)	4.28	N-F	0 / 691	0.11 (1)
G-H	-2317 / 0	-91.8 -91.8	0.38 (1)	4.16	L-F	0 / 266	0.08 (1)
H-I	0 / 35	-91.8 -91.8	0.12 (1)	10.00	L-G	-218 / 0	0.18 (1)
R-B	-2022 / 0	0.0 0.0	0.21 (1)	5.94	K-G	-321 / 0	0.11 (1)
J-H	-2022 / 0	0.0 0.0	0.21 (1)	5.94	B-Q	0 / 1996	0.45 (1)
R-Q	0 / 0	-18.5 -18.5	0.10 (4)	10.00	K-H	0 / 1995	0.45 (1)
Q-P	0 / 1953	-18.5 -18.5	0.40 (1)	10.00			
P-O	0 / 1794	-18.5 -18.5	0.41 (1)	10.00			
O-N	0 / 1794	-18.5 -18.5	0.41 (1)	10.00			
N-M	0 / 1794	-18.5 -18.5	0.41 (1)	10.00			
M-L	0 / 1794	-18.5 -18.5	0.41 (1)	10.00			
L-K	0 / 1953	-18.5 -18.5	0.40 (1)	10.00			
K-J	0 / 0	-18.5 -18.5	0.10 (4)	10.00			

TOTAL WEIGHT = 2 X 158 = 317 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 8.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. G.C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSI: TC=0.81/1.00 (D-E:1), BC=0.41/1.00 (N-P:1),
WB=0.45/1.00 (B-Q:1), SS=0.34/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.97 (B) (INPUT = 0.90)
JSI METAL = 0.64 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007150

[illegible]

JSI GRIP= 0.87 (B) (INPUT = 0.90)
JSI METAL= 0.56 (M) (INPUT = 1.00)


Structural component only
DWG# T-2007151

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408169	T26	5	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MIT Industries, Inc. Set Apr 25 12:49:32 2020 Page 1

ID:K7TPdhgJ0npl1qYdbWIOFzIdeG-TgCuMjyo9JC7yPVA3e9rlawTUKjTsYXBCoXigDzNBDX

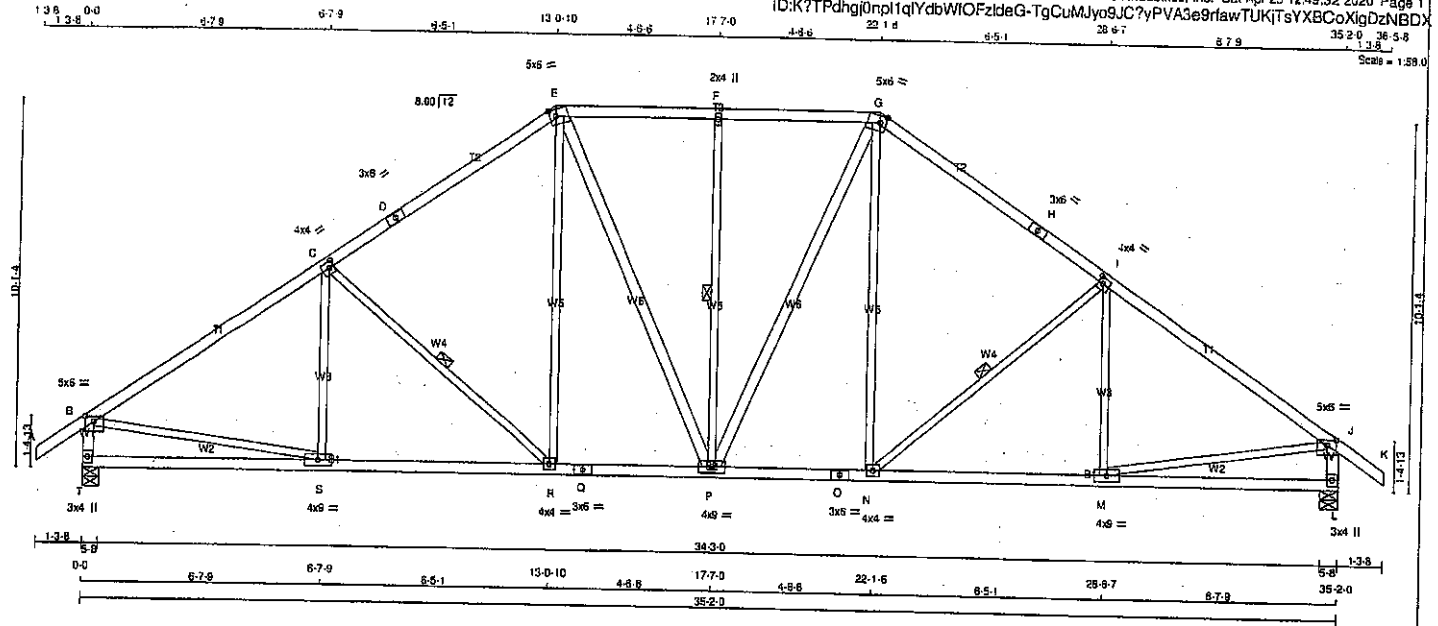

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
A - D	2x4	DRY No.2
D - E	2x4	DRY No.2
E - G	2x4	DRY No.2
G - H	2x4	DRY No.2
H - I	2x4	DRY No.2
I - J	2x4	DRY No.2
J - K	2x4	DRY No.2
K - L	2x4	DRY No.2
ALL WEBS EXCEPT	2x3	DRY No.2
E - P	2x4	DRY No.2
P - G	2x4	DRY No.2

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT 2065	DOWN 2065	0	5-8
T	HORIZ 0	HORIZ 0	0	5-8
L	VERT 2065	DOWN 2065	0	5-8

UNFACTORED REACTIONS

	1ST LCASE	MAX / MIN COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERALIVE WIND DEAD SOIL
T	1458	970 / 0 0 / 0 0 / 0 0 / 0 488 / 0 0 / 0
L	1458	970 / 0 0 / 0 0 / 0 0 / 0 488 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-R, F-P, IN.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO	A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	S-C	-189 / 46	0.10 (1)
	B-C	-2359 / 0	-91.8	-91.8	0.89 (1)	3.77	C-R	-485 / 0	0.24 (1)
	C-D	-1998 / 0	-91.8	-91.8	0.82 (1)	4.11	R-E	0 / 415	0.09 (1)
	D-E	-1998 / 0	-91.8	-91.8	0.82 (1)	4.11	E-P	0 / 315	0.05 (1)
	E-F	-1781 / 0	-91.8	-91.8	0.27 (1)	4.77	P-F	-502 / 0	0.35 (1)
	F-G	-1781 / 0	-91.8	-91.8	0.27 (1)	4.77	P-G	0 / 315	0.05 (1)
	G-H	-1998 / 0	-91.8	-91.8	0.82 (1)	4.11	N-G	0 / 415	0.09 (1)
	H-I	-1998 / 0	-91.8	-91.8	0.82 (1)	4.11	N-I	-484 / 0	0.24 (1)
	I-J	-2359 / 0	-91.8	-91.8	0.89 (1)	3.77	M-I	-189 / 46	0.10 (1)
	J-K	0 / 35	-91.8	-91.8	0.12 (1)	10.00	B-S	0 / 2022	0.45 (1)
	K-L	-2014 / 0	0.0	0.0	0.21 (1)	5.95	M-J	0 / 2021	0.45 (1)
	L-J	-2014 / 0	0.0	0.0	0.21 (1)	5.95			
	T-S	0 / 0	-18.5	-18.5	0.19 (4)	10.00			
	S-R	0 / 1998	-18.5	-18.5	0.42 (1)	10.00			
	R-Q	0 / 1629	-18.5	-18.5	0.32 (1)	10.00			
	Q-P	0 / 1629	-18.5	-18.5	0.32 (1)	10.00			
	P-O	0 / 1629	-18.5	-18.5	0.32 (1)	10.00			
	O-N	0 / 1629	-18.5	-18.5	0.32 (1)	10.00			
	N-M	0 / 1998	-18.5	-18.5	0.42 (1)	10.00			
	M-L	0 / 0	-18.5	-18.5	0.19 (4)	10.00			

TOTAL WEIGHT = 5 X 172 = 858 Lb

(M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 085-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.17")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.09")
ALLOWABLE DEFL.(TL) = $L/360$ (1.17")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.18")

CSI: TC=0.69/1.00 (B-C:1), BC=0.42/1.00 (R-S:1), WB=0.45/1.00 (B-S:1), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 788 1887 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (B) (INPUT = 0.90)
JSI METAL= 0.50 (D) (INPUT = 1.00)




Structural component only
DWG# T-2007152

JOB NAME 408169	TRUSS NAME T27	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S.Oct 29 2019 MTek Industries, Inc. Sat Apr 25 12:49:33 2020 Page 1
ID:K?TPdngi0npl1q1YdbWIOFzldG-xlmGZtRwdK/ZZ4MdMq4CoSb3k2Cb?nKQSHGctzNBOW

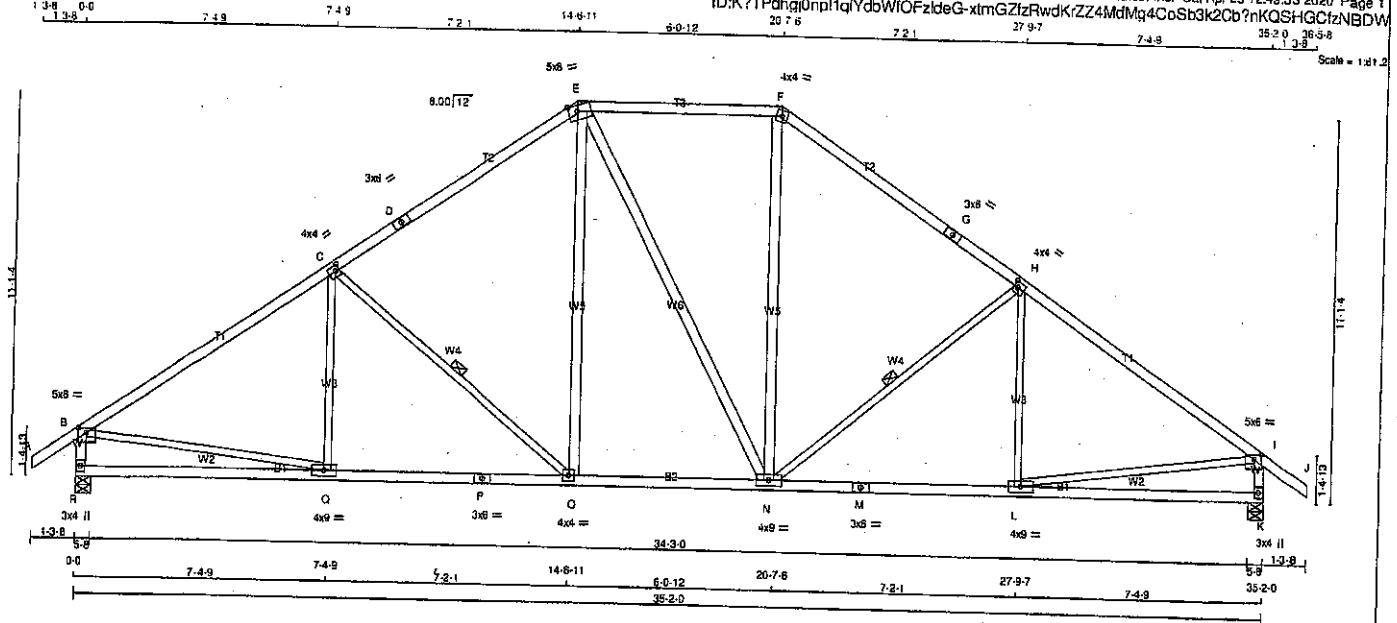

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
F - G	2x4	DRY	No.2	SPF	
G - J	2x4	DRY	No.2	SPF	
J - B	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
P - M	2x4	DRY	No.2	SPF	
M - K	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT	2x4	DRY	No.2	SPF	
O - E	2x4	DRY	No.2	SPF	
N - N	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	5.0	1.75 2.75
C	TMVW-l	MT20	4.0	4.0	2.00 1.50
D	TS-t	MT20	3.0	6.0	
E	TTWW-m	MT20	5.0	8.0	2.00 3.00
F	TTW-m	MT20	4.0	4.0	
G	TS-t	MT20	3.0	6.0	
H	TMVW-l	MT20	4.0	4.0	2.00 1.50
I	TMVW-p	MT20	5.0	6.0	1.75 2.75
K	BMV-l-p	MT20	3.0	4.0	
L	BMVW-l	MT20	4.0	9.0	
M	BS-l	MT20	3.0	6.0	
N	BMVW-l	MT20	4.0	9.0	
O	BMVW-l	MT20	4.0	4.0	
P	BS-l	MT20	3.0	6.0	
Q	BMVW-l	MT20	4.0	9.0	
R	BMV-l-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	IN-SX	IN-SX
R	2065	0	0	5-8
K	2065	0	0	5-8

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
R	1458	970 / 0
K	1458	970 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.45 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX	MAX	WEBS	MAX. FACTORED	MAX
MEMB.	FORCE	VERT. LOAD	LC1	MAX	MEMB.	FORCE	MAX
(LBS)	(LBS)	(PLF)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	Q-C	-139 / 76
B-C	-2359 / 0	-91.8	-91.8	0.89 (1)	3.45	O-E	-805 / 0
C-D	-1888 / 0	-91.8	-91.8	0.78 (1)	3.91	O-E	0 / 499
D-E	-1888 / 0	-91.8	-91.8	0.78 (1)	3.91	E-N	0 / 0
E-F	-1538 / 0	-91.8	-91.8	0.47 (1)	4.74	N-F	0 / 500
F-G	-1888 / 0	-91.8	-91.8	0.78 (1)	3.91	N-H	-604 / 0
G-H	-1888 / 0	-91.8	-91.8	0.78 (1)	3.91	L-H	-140 / 75
H-I	-2357 / 0	-91.8	-91.8	0.89 (1)	3.45	B-Q	0 / 2020
I-J	0 / 35	-91.8	-91.8	0.12 (1)	10.00	L-I	0 / 2019
R-B	-2009 / 0	0.0	0.0	0.21 (1)	5.95		
K-I	-2009 / 0	0.0	0.0	0.21 (1)	5.95		
R-Q	0 / 0	-18.5	-18.5	0.25 (4)	10.00		
Q-P	0 / 1999	-18.5	-18.5	0.45 (1)	10.00		
P-O	0 / 1999	-18.5	-18.5	0.45 (1)	10.00		
O-N	0 / 1538	-18.5	-18.5	0.33 (1)	10.00		
N-M	0 / 1998	-18.5	-18.5	0.45 (1)	10.00		
M-L	0 / 1998	-18.5	-18.5	0.45 (1)	10.00		
L-K	0 / 0	-18.5	-18.5	0.24 (4)	10.00		

TOTAL WEIGHT = 2 X 168 = 333 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)

CALCULATED VERT. DEFL.(LL) = U/999 (0.08")

ALLOWABLE DEFL.(TL) = L/360 (1.17)

CALCULATED VERT. DEFL.(TL) = U/999 (0.20")

CSI: TC=0.89/1.00 (B-C:1), BC=0.45/1.00 (D-Q:1),

WB=0.45/1.00 (B-Q:1), SS=0.27/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (F) (INPUT = 0.90)

JSI METAL = 0.65 (P) (INPUT = 1.00)

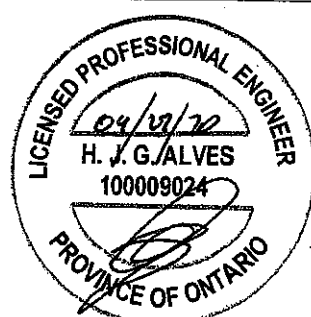


Structural component only
DWG# T-2007153

JOB NAME 408169	TRUSS NAME T28	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITK Industries, Inc. Sat Apr 25 12:49:34 2020 Page 1

ID:K7TPdhgJ0np1qYdbWIOFzIdeG-P3Jfn?_3gwSIBjYB3Bjk??uz8RBKVIUf80pISzNB0V

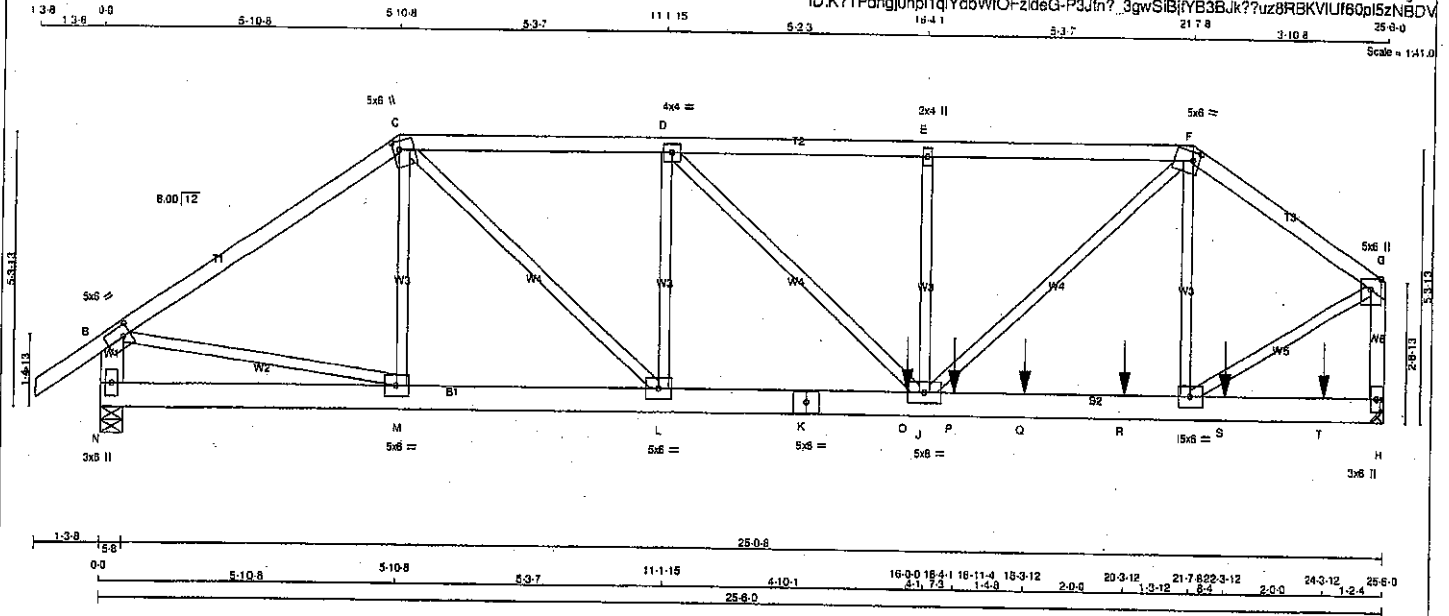

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - F	2x4	DRY	No.2	SPF		
F - G	2x4	DRY	No.2	SPF		
H - G	2x4	DRY	No.2	SPF		
H - K	2x4	DRY	No.2	SPF		
K - H	2x4	DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 1 12	TOP	
C - F 1 12	TOP	
F - G 1 12	TOP	
H - G 1 12	TOP	
N - B 2 12	TOP	
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
N - K 2 12	TOP	
K - H 2 12	SIDE(183.1)	
WEBS : (0.122"x3") SPIRAL NAILS		
E - J 1 6	SIDE(77.0)	
2x3 1 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
N	2086	0	0	5-8
H	2756	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

1ST LOASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
N	1470	994 / 0	0 / 0	0 / 0	0 / 0	476 / 0
H	1941	1320 / 0	0 / 0	0 / 0	0 / 0	620 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.76 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO									
A-B	0 / 35	-91.8	-91.8	0.07 (1)	10.00	M-C	-218 / 22	0.04 (1)	
B-C	-2363 / 0	-91.8	-91.8	0.37 (1)	5.41	C-L	0 / 1550	0.18 (1)	
C-D	-3093 / 0	-91.8	-91.8	0.24 (1)	5.03	L-D	-928 / 0	0.19 (1)	
D-E	-3519 / 0	-91.8	-91.8	0.25 (1)	4.76	D-J	0 / 589	0.07 (1)	
E-F	-3519 / 0	-91.8	-91.8	0.24 (1)	4.79	J-E	-508 / 0	0.10 (1)	
F-G	-2362 / 0	-91.8	-91.8	0.16 (1)	5.69	J-F	0 / 2156	0.27 (1)	
N-B	-2037 / 0	0.0	0.0	0.07 (1)	7.81	I-F	-548 / 0	0.11 (1)	
H-G	-2632 / 0	0.0	0.0	0.19 (1)	7.01	B-M	0 / 1991	0.25 (1)	
						I-G	0 / 2264	0.28 (1)	
N-M	0 / 0	-18.5	-18.5	0.04 (4)	10.00				
M-L	0 / 1859	-18.5	-18.5	0.14 (1)	10.00				
L-K	0 / 3083	-18.5	-18.5	0.27 (1)	10.00				
K-O	0 / 3093	-18.5	-18.5	0.27 (1)	10.00				
O-J	0 / 3093	-18.5	-18.5	0.27 (1)	10.00				
J-P	0 / 1942	-18.5	-18.5	0.23 (1)	10.00				
P-Q	0 / 1942	-18.5	-18.5	0.23 (1)	10.00				
Q-R	0 / 1942	-18.5	-18.5	0.23 (1)	10.00				
R-I	0 / 1942	-18.5	-18.5	0.23 (1)	10.00				
I-S	0 / 0	-18.5	-18.5	0.10 (1)	10.00				
S-T	0 / 0	-18.5	-18.5	0.10 (1)	10.00				
T-H	0 / 0	-18.5	-18.5	0.10 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

LOC	LOC	MAX	MAX	FACE	DIR.	TYPE	HEEL	CONN.
JT	18-0-9	-997	-997	---	FRONT	VERT	---	C1
O	18-11-4	-187	-187	---	FRONT	VERT	---	C1
P	18-3-12	-187	-187	---	FRONT	VERT	---	C1
Q	20-3-12	-187	-187	---	FRONT	VERT	---	C1
R	22-3-12	-174	-174	---	FRONT	VERT	---	C1
S	24-3-12	-173	-173	---	FRONT	VERT	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 122 = 245 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCSC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.85")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (0.85")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CS: TC=0.37/1.00 (B-C:1), BC=0.27/1.00 (J-L:1),
WB=0.28/1.00 (G-I:1), SS=0.34/1.00 (J-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.90 (F) (INPUT = 0.90)
JSI METAL= 0.45 (G) (INPUT = 1.00)

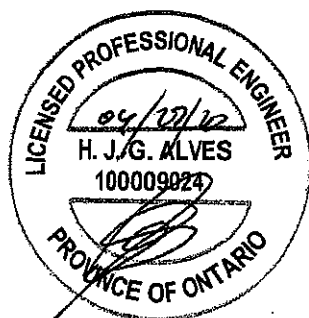

Structural component only
DWG# T-2007154 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T28	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington


TRUSS DESC.

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 12:49:34 2020 Page 2
ID:K?TPdhaDnol1qYdbWfOFzIdeG-P3J/n? 3qwsIBifYB3BJk??uz8RBKVUf60p5zNBDV

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	6.0	2.50	1.75
C	TTWW+m	MT20	5.0	6.0	2.00	1.50
D	TMVW-l	MT20	4.0	4.0		
E	TMVW+w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.00	1.50
G	TMVW+p	MT20	5.0	6.0	Edge	
H	BMV1+p	MT20	3.0	6.0		
I, L, M						
I	BMWW-t	MT20	5.0	6.0		
J	BMWWW-t	MT20	5.0	8.0		
K	BS-t	MT20	5.0	6.0		
N	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

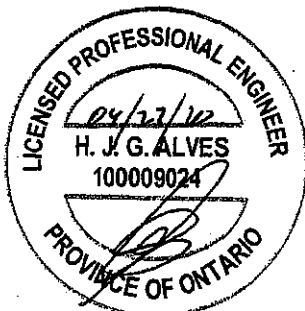


Structural component only
DWG# T-2007154 *YV*

JOB NAME 408169	TRUSS NAME T29	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 12:49:35 2020 Page 1
ID:K7TPdngi0npl1qYdbWOCFzdeG-IFt1.L_hREaZptDknjYHDYdYm23pNduumMHYzNBDU

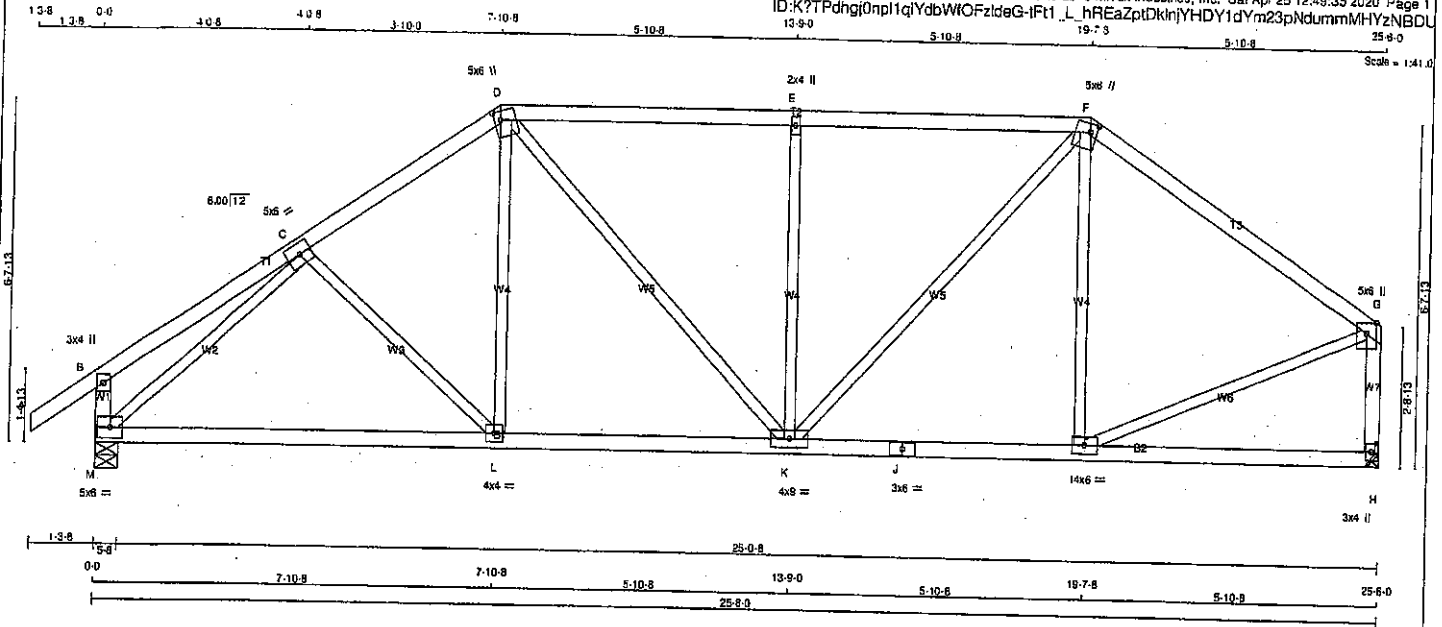

LUMBER	CHORDS	SIZE	DRY	LUMBER
N. L. G. A. RULES				
A - D	2x4	DRY	No.2	
D - F	2x4	DRY	No.2	
F - G	2x4	DRY	No.2	
M - B	2x4	DRY	No.2	
H - G	2x4	DRY	No.2	
M - J	2x4	DRY	No.2	
J - H	2x4	DRY	No.2	

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY, SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	5.0	6.0		
D	TTWW+m	MT20	5.0	6.0	2.00	1.50
E	TMW+w	MT20	2.0	4.0		
F	TTWW+m	MT20	5.0	6.0	2.00	1.50
G	TMVW+p	MT20	5.0	6.0	Edge	
H	BMV1+p	MT20	3.0	4.0		
I	BMWW-t	MT20	4.0	6.0		
J	BS-t	MT20	3.0	6.0		
K	BMWWW-t	MT20	4.0	9.0		
L	BMWW-t	MT20	4.0	4.0		
M	BMVW-t	MT20	5.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UP	IN-SX
M	1532	0	1532	0
H	1406	0	1406	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	1081	723 / 0	0 / 0	0 / 0	0 / 0	358 / 0	0 / 0
H	994	652 / 0	0 / 0	0 / 0	0 / 0	342 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.89 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED	FORCE	VERT.	LOAD	LC1	MAX	MAX.	UNBRAC	LENGTH	FR-TO	MEMB.	MAX. FACTORED	FORCE	MAX
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	C-L	-80 / 27	0.04 (1)						
B-C	0 / 22	-91.8	-91.8	0.22 (1)	10.00	L-D	0 / 209	0.05 (4)						
C-D	-1491 / 0	-91.8	-91.8	0.19 (1)	5.19	D-K	0 / 354	0.08 (1)						
D-E	-1494 / 0	-91.8	-91.8	0.44 (1)	4.89	K-E	-662 / 0	0.48 (1)						
E-F	-1494 / 0	-91.8	-91.8	0.44 (1)	4.89	K-F	0 / 563	0.15 (1)						
F-G	-1226 / 0	-91.8	-91.8	0.44 (1)	5.25	I-F	-282 / 0	0.21 (1)						
M-B	-255 / 0	0.0	0.0	0.03 (1)	7.81	M-C	-1757 / 0	0.83 (1)						
H-G	-1362 / 0	0.0	0.0	0.20 (1)	6.96	I-G	0 / 1098	0.25 (1)						
M-L	0 / 1279	-18.5	-18.5	0.35 (4)	10.00									
L-K	0 / 1223	-18.5	-18.5	0.36 (4)	10.00									
K-J	0 / 1014	-18.5	-18.5	0.26 (1)	10.00									
J-I	0 / 1014	-18.5	-18.5	0.28 (1)	10.00									
I-H	0 / 0	-18.5	-18.5	0.17 (4)	10.00									

TOTAL WEIGHT = 109 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.85")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.85")
CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.44/1.00 (F-G:1), BC=0.36/1.00 (K-L:4), WB=0.83/1.00 (C-M:1), SS=0.26/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	616	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.82 (D) (INPUT = 0.90)
JSI METAL = 0.51 (G) (INPUT = 1.00)

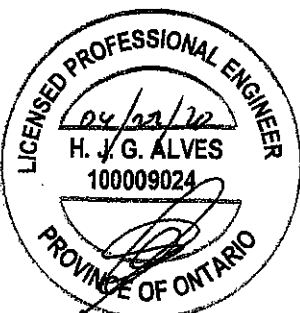


Structural component only
DWG# T-2007155

JOB NAME 408169	TRUSS NAME T30	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 MTek Industries, Inc. Sat Apr 25 12:49:36 2020 Page 1
ID:K?TPdghj0npl1q1YdbWfOfZldeG-MSRPCg?JCYIQQ10xUEnpQ4FSy9zoKVn7QVwp_zNBDT

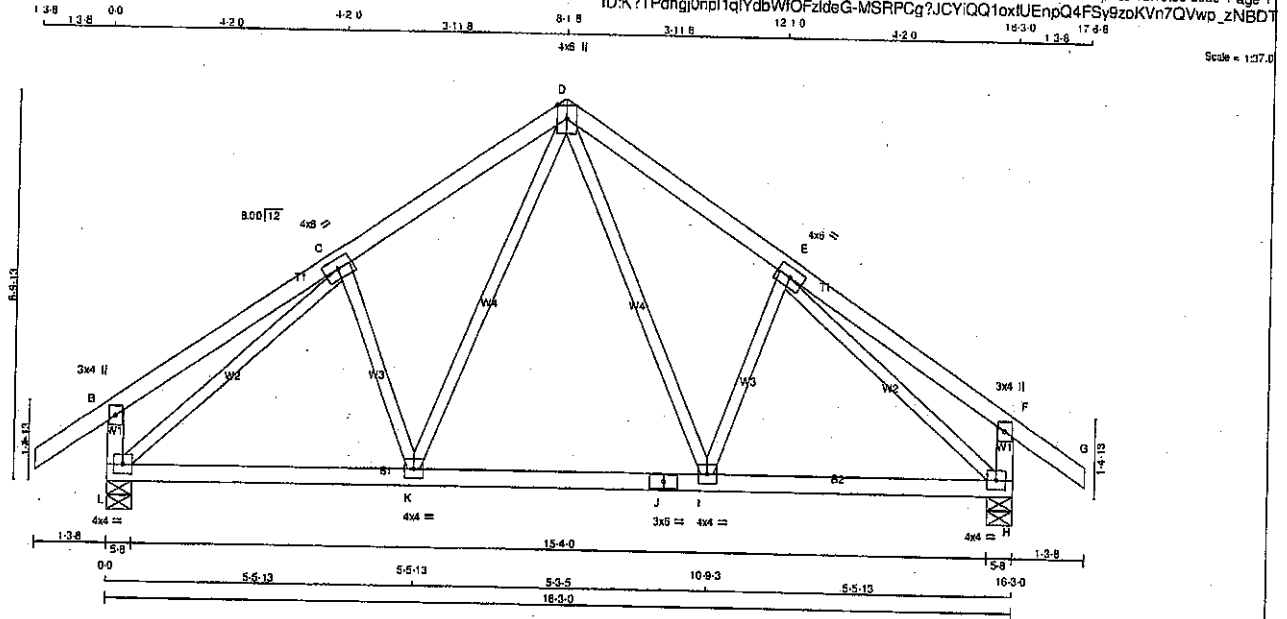

Scale = 1/2" = 1'-0"

LUMBER

N. L. G. A. RULES	
CHORDS	SIZE
A - D	2x4
D - G	2x4
L - B	2x4
H - F	2x4
L - J	2x4
J - H	2x4

ALL WEBS 2x3 DRY No.2

EXCEPT DRY-SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0		
C	TMVW-H	MT20	4.0	6.0		
D	TTWV-p	MT20	4.0	8.0	Edge	
E	TMVW-H	MT20	4.0	8.0		
F	TMV-p	MT20	3.0	4.0		
H	BMVW-H	MT20	4.0	4.0		
I	BMVW-H	MT20	4.0	4.0		
J	BS-H	MT20	3.0	5.0		
K	BMVW-H	MT20	4.0	4.0		
L	BMVW-H	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	UPLIFT
L	1022	0	1022	0
H	1022	0	1022	0

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED SNOW LIVE PERMLIVE WIND DEAD SOIL
L	720 486 / 0 0 / 0 0 / 0 0 / 0 234 / 0 0 / 0
H	720 486 / 0 0 / 0 0 / 0 0 / 0 234 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSF (LC)	MAX. UNBRAC LENGTH	WEBS	MAX. FACTORED MEMB. FORCE (LBS)	MAX. CSF (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 35	-91.8 -91.8	0.12 (1)	10.00	D-I	-0 / 396	0.08 (1)
B-C	0 / 24	-91.8 -91.8	0.24 (1)	10.00	I-E	-217 / 0	0.08 (1)
C-D	-845 / 0	-91.8 -91.8	0.19 (1)	6.25	K-D	0 / 396	0.08 (1)
D-E	-845 / 0	-91.8 -91.8	0.19 (1)	6.25	C-K	-217 / 0	0.06 (1)
E-F	0 / 24	-91.8 -91.8	0.24 (1)	10.00	L-C	-1042 / 0	0.52 (1)
F-G	0 / 35	-91.8 -91.8	0.12 (1)	10.00	E-H	-1042 / 0	0.52 (1)
L-B	-268 / 0	0.0 0.0	0.03 (1)	7.81			
H-F	-268 / 0	0.0 0.0	0.03 (1)	7.81			
L-K	0 / 762	-18.5 -18.5	0.19 (1)	10.00			
K-J	0 / 557	-18.5 -18.5	0.17 (4)	10.00			
J-I	0 / 557	-18.5 -18.5	0.17 (4)	10.00			
I-H	0 / 762	-18.5 -18.5	0.19 (1)	10.00			

TOTAL WEIGHT = 2 X 72 = 144 LB

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.54")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.02")
ALLOWABLE DEFL.(TL) = $L/360$ (0.54")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.04")

CSF: TC=0.24/1.00 (B-D:1), BC=0.19/1.00 (H-I:1),
WB=0.52/1.00 (C-L:1), SSI=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PS)	(PL)	(PL)
	MAX	MIN	MAX
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (H) (INPUT = 0.90)
JSI METAL = 0.29 (L) (INPUT = 1.00)




Structural component only
DWG# T-2007156

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC	GREEN PARK HOMES	DRWG NO.
408169	T30A	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:37 2020 Page 1
ID:k?TPahgJ0npi1qYdbWfOfzIdeG-qe?nPO0xzrqH2AN7sC10MedQCLVGXo_wL4FTLQzNBDS

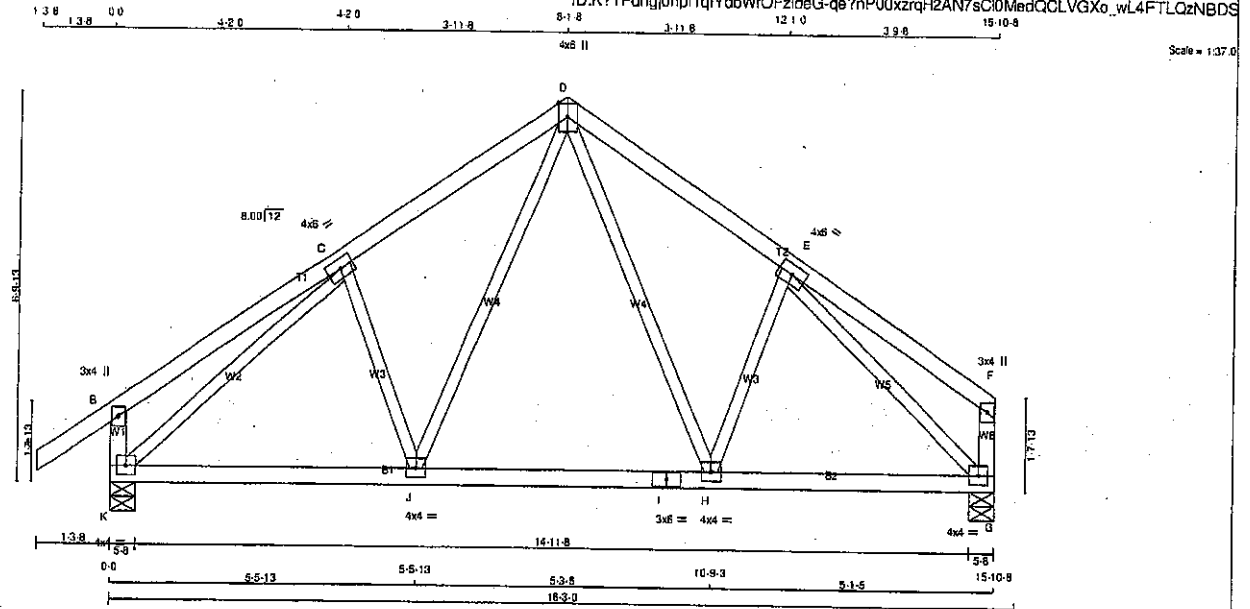

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
K - B	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0		
C	TMWV-4	MT20	4.0	6.0		
D	TMWV-p	MT20	4.0	6.0	Edge	
E	TMV-p	MT20	4.0	6.0		
F	BMVW1-1	MT20	3.0	4.0		
G	BMVW1-1	MT20	4.0	4.0		
H	BMVW1-1	MT20	4.0	4.0		
I	BS-1	MT20	3.0	8.0		
J	BMVW1-1	MT20	4.0	4.0		
K	BMVW1-1	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX	BRG
K	1001	0	1001	0	0	5-8	5-8	5-8	5-8
G	875	0	875	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	708	476 / 0	0 / 0	0 / 0	0 / 0	229 / 0	0 / 0
G	619	408 / 0	0 / 0	0 / 0	0 / 0	213 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT.	LOAD (LBS)	MAX.	CS (LC)	MEMB.	FORCE (LBS)	MAX.	CS (LC)
FR-TO		FROM	TO			FR-TO			
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	D-H	0 / 272	0.06 (1)	
B-C	0 / 24	-91.8	-91.8	0.24 (1)	10.00	H-E	-180 / 2	0.05 (1)	
C-D	-817 / 0	-91.8	-91.8	0.19 (1)	6.25	J-D	0 / 342	0.08 (1)	
D-E	-783 / 0	-91.8	-91.8	0.18 (1)	6.25	C-J	-222 / 0	0.06 (1)	
E-F	0 / 24	-91.8	-91.8	0.22 (1)	10.00	K-C	-1012 / 0	0.51 (1)	
K-B	-298 / 0	0.0	0.0	0.03 (1)	7.61	E-G	-992 / 0	0.44 (1)	
G-F	-124 / 0	0.0	0.0	0.01 (1)	7.61				
K-J	0 / 740	-18.5	-18.5	0.18 (1)	10.00				
J-I	0 / 531	-18.5	-18.5	0.17 (4)	10.00				
I-H	0 / 531	-18.5	-18.5	0.17 (4)	10.00				
H-G	0 / 691	-18.5	-18.5	0.17 (1)	10.00				

TOTAL WEIGHT = 2 X 70 = 140 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	25.6	PSF
	DL	6.0	PSF
BOT CH.	LL	0.0	PSF
	DL	7.4	PSF
TOTAL LOAD		39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2015, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.53")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.53")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.24/1.00 (B-C:1), BC=0.18/1.00 (J-K:1), WB=0.51/1.00 (C-K:1), SS=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LG BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788 1987 1655

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (K) (INPUT = 0.90)
JSI METAL= 0.28 (K) (INPUT = 1.00)

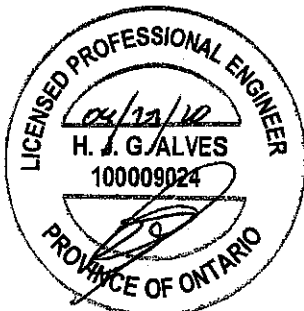

Structural component only
DWG# T-2007157

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Sat Apr 25 12:49:38 2020 Page 1
ID:K?TPdhgjOnp1qIYdbWIOFzIdeG-lqZ9dM1Zk9y8gKyJQvGFvAbEImYGAw4ak_fuszNBDF




Structural component only
DWG# T-2007158

JOB NAME 408169	TRUSS NAME T31S	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:49:39 2020 Page 1
ID:K?TPdhgJ0np1qYdbWfOFzdeG-m17Yqj1BVT4?HUXW_dhUR3inH9Cs?pxDpOkaQJzNBDC

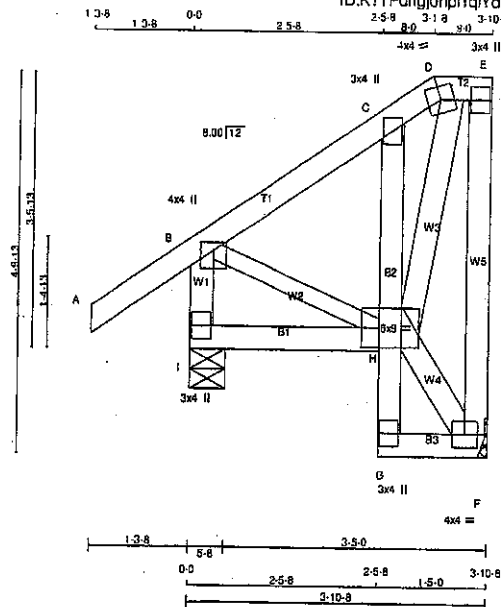

TOTAL WEIGHT = 29 lb

LUMBER				
N.L.G.A. RULES	SIZE	LUMBER	DESCR.	
CHORDS				
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
I - B	2x4	DRY	No.2	SPF
I - H	2x4	DRY	No.2	SPF
G - C	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x4	DRY	No.2	SPF
B - H	2x3	DRY	No.2	SPF
DRY; SEASONED LUMBER.				

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TMV+p	MT20	3.0	4.0		
D	TTW-m	MT20	4.0	4.0		
E	TMV+p	MT20	3.0	4.0		
F	BMVW1-t	MT20	4.0	4.0		
G	BMV+p	MT20	3.0	4.0		
H	BVMWVW-t	MT20	6.0	9.0	3.00	2.75
I	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG	BRG
F	193	0	193	0	0	5-8	5-8		
I	361	0	361	0	0	5-8	5-8		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	136	88 / 0	0 / 0	0 / 0	0 / 0	49 / 0	0 / 0
I	252	181 / 0	0 / 0	0 / 0	0 / 0	72 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8 -91.8	0.14 (5)	H-F	-27 / 0	0.00 (1)	
B-C	-87 / 0	-91.8 -91.8	0.03 (1)	B-H	0 / 68	0.02 (1)	
C-D	-99 / 0	-91.8 -91.8	0.07 (1)	H-D	0 / 173	0.03 (1)	
D-E	-11 / 0	-91.8 -91.8	0.07 (1)				
E-F	-148 / 0	0.0 0.0	0.04 (1)				
F-B	-327 / 0	0.0 0.0	0.02 (4)				
I-H	0 / 8	-18.5 -18.5	0.03 (4)				
G-H	-2 / 8	0.0 0.0	0.05 (1)				
H-C	-203 / 0	0.0 0.0	0.04 (1)				
G-F	0 / 30	-18.5 -18.5	0.03 (1)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.14/1.00 (A-B-5), BC=0.05/1.00 (G-H-1), WB=0.03/1.00 (D-H-1), SSI=0.12/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.23 (B) (INPUT = 0.90)
JSI METAL=0.07 (B) (INPUT = 1.00)

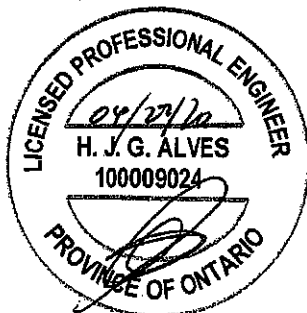


Structural component only
DWG# T-2007159

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408169	T32S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 12:49:40 2020 Page 1
ID:K?TPdghjOnp1qYdbWfOfZldeG-EDhw122qGmCsve6iXKlI_GfY1ZYDkG4M22T7yzNBDF

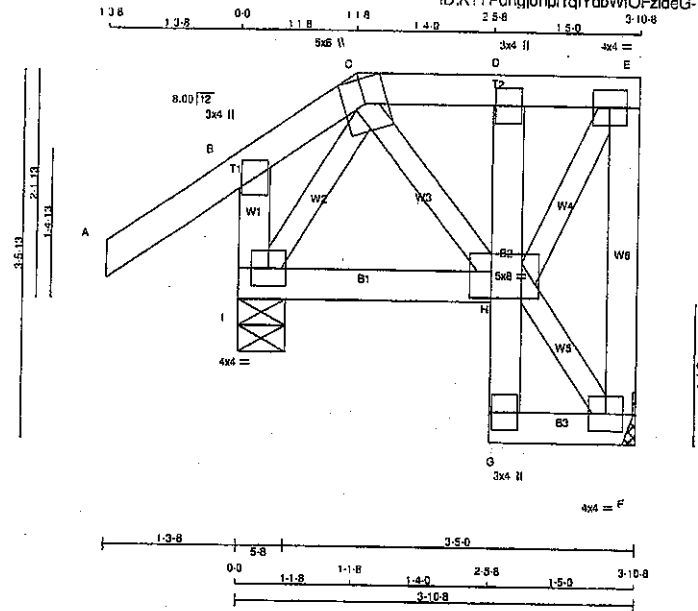

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
A - C	2x4 DRY	No.2
C - E	2x4 DRY	No.2
F - E	2x4 DRY	No.2
I - B	2x4 DRY	No.2
I - H	2x4 DRY	No.2
G - D	2x4 DRY	No.2
G - F	2x4 DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table(s) in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW+H	MT20	5.0	6.0	Edge	
D	TMV+p	MT20	3.0	4.0		
E	TMVW+I	MT20	4.0	4.0		
F	BMVW1-t	MT20	4.0	4.0		
G	BMV+p	MT20	3.0	4.0		
H	BMVWVW+I	MT20	5.0	8.0	3.00	2.50
I	BMVW1-t	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORIZ	UPLIFT
F	191	0	191	0
I	362	0	362	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	136	87 / -12	0 / 0	0 / 0	0 / 0	49 / 0	0 / 0
I	253	182 / 0	0 / 0	0 / 0	0 / 0	71 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. GSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. GSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8	-91.8 0.14 (5)	10.00	C-H	0 / 80	0.01 (1)
B-C	-41 / 0	-91.8	-91.8 0.13 (5)	6.25	H-F	-7 / 0	0.00 (1)
C-D	-89 / 0	-91.8	-91.8 0.02 (1)	6.25	H-E	0 / 153	0.03 (1)
D-E	-85 / 0	-91.8	-91.8 0.02 (1)	6.25	F-C	-100 / 34	0.02 (1)
F-E	-175 / 0	0.0	0.0 0.03 (1)	7.81			
I-B	-253 / 0	0.0	0.0 0.03 (1)	7.81			
I-H	-18 / 53	-18.5	-18.5 0.04 (4)	6.25			
G-H	0 / 13	0.0	0.0 0.01 (1)	10.00			
H-D	-142 / 0	0.0	0.0 0.01 (1)	7.81			
G-F	0 / 5	-18.5	-18.5 0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 25 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 81.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (A-B:5), BC=0.04/1.00 (H-I:4), WB=0.03/1.00 (E-H:1), SS=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
	MAX MIN	MAX MIN
MT20	618 354	1697 788


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP=0.18 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)

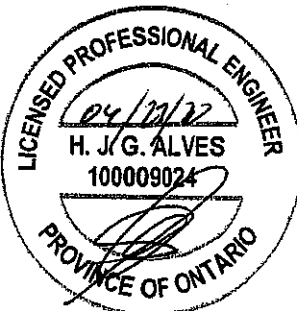


Structural component only
DWG# T-2007160

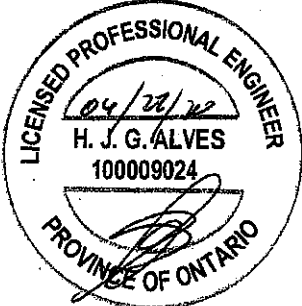JOB NAME 408169	TRUSS NAME T33	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.														
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:41 2020 Page 2 ID:K?TPdHg0npl1glYdbWtOFzIdeG-PFI03S14LiXohu51pyWUo8MznVTetWGiDhUBzNBOC																	
PLATES (tablets in inches) <table border="1"><thead><tr><th>JT</th><th>TYPE</th><th>PLATES</th><th>W</th><th>LEN</th><th>Y</th><th>X</th></tr></thead><tbody><tr><td>F</td><td>BMV1+p</td><td>MT20</td><td>3.0</td><td>6.0</td><td></td><td></td></tr></tbody></table> Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.						JT	TYPE	PLATES	W	LEN	Y	X	F	BMV1+p	MT20	3.0	6.0		
JT	TYPE	PLATES	W	LEN	Y	X													
F	BMV1+p	MT20	3.0	6.0															
 Structural component only DWG# T-2007161 22																			

JOB NAME	TRUSS NAME	QUANTITY	PLY.	JOB DESC.	DRWG NO.
408170	T40	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.3.10 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 13:02:15 2020 Page 1
ID:K?TPdhgJ0npl1qYdbWtOFzIdaG-dToLVCBPTKk_gKpGOLn4U0ubv6N8dVf?sayUzNB1c
1.3-8 0.0 5.10-8 5.10-8 5.10-14 11.9-6 5.9-10 17.7-0 19.2-12 4.1-14 23.4-10 5.10-14 29.3-8 5.10-8 35.2-0 36.5-8 1.3-8
Scale = 1/8" = 1'-0"

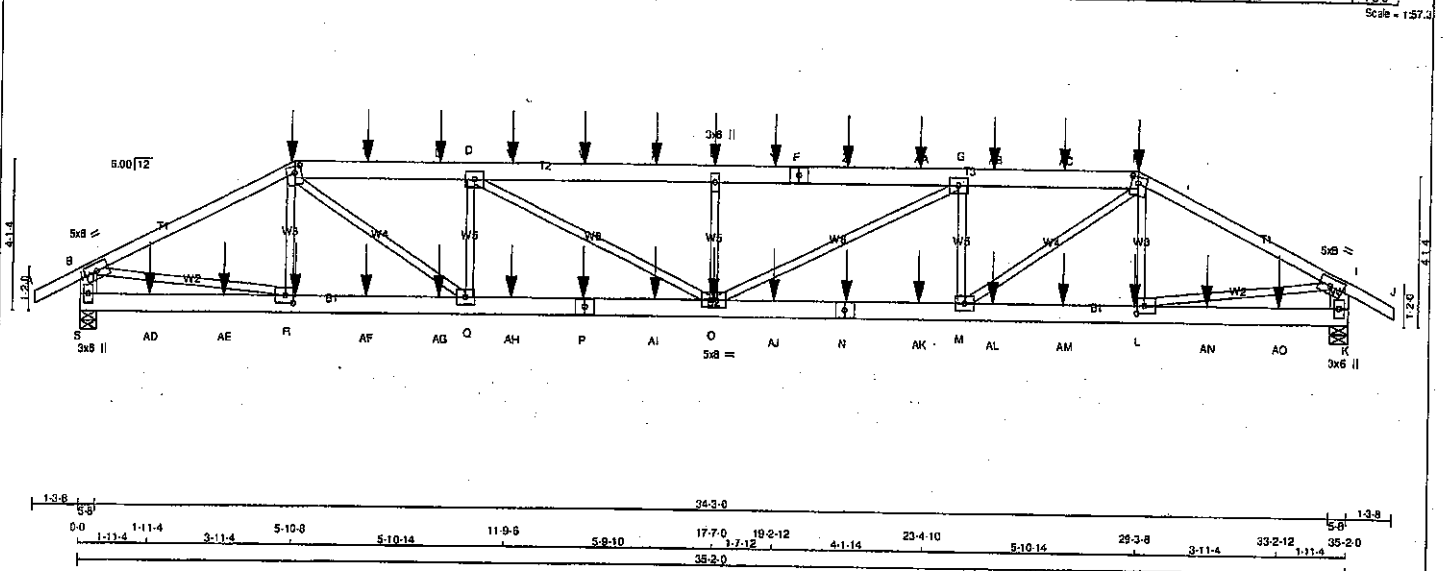

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES	A - C	2x4	DRY	No.2	SPF
	C - F	2x6	DRY	No.2	SPF
	F - H	2x6	DRY	No.2	SPF
	H - J	2x4	DRY	No.2	SPF
	S - B	2x6	DRY	No.2	SPF
	K - I	2x6	DRY	No.2	SPF
	S - P	2x6	DRY	No.2	SPF
	P - N	2x6	DRY	No.2	SPF
	N - K	2x6	DRY	No.2	SPF
	ALL WEBS	2x3	DRY	No.2	SPF
	EXCEPT				

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE (61.0)
H - J	12	SIDE (61.0)
C - F	12	SIDE (61.0)
F - H	12	SIDE (61.0)
S - B	12	TOP
K - I	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S - P	12	SIDE (183.1)
P - N	12	SIDE (183.1)
N - K	12	SIDE (183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	1	S

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
	GROSS REACTION	GROSS REACTION	DOWN	HORZ	BRG	BRG	IN-SX	IN-SX
JT	3331	0	3331	0	0	5-8	5-8	
S	3331	0	3331	0	0	5-8	5-8	
K	3331	0	3331	0	0	5-8	5-8	

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL
S	2355 1544 / 0 0 / 0 0 / 0 812 / 0 0 / 0
K	2355 1544 / 0 0 / 0 0 / 0 812 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.87 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MAX. FACTORED		FACTORED		MEMB.		MAX. FACTORED		
MEMB.	FORCE	VERT. LOAD LC1	MAX	MAX.	MEMB.	FORCE	MAX	
	(LBS)	(PLF)	CSI (LC)	UNBRAC		(LBS)	CSI (LC)	
FR-TO		FROM	TO	LENGTH	FR-TO			
A-B	0 / 28	-91.8	-91.8	0.07 (1)	10.00	R-C	-449 / 0	0.06 (1)
B-C	-5069 / 0	-91.8	-91.8	0.52 (1)	3.87	C-Q	0 / 3021	0.37 (1)
C-T	-6976 / 0	-91.8	-91.8	0.24 (1)	4.35	Q-D	-1808 / 0	0.19 (1)
T-U	-6976 / 0	-91.8	-91.8	0.24 (1)	4.35	D-O	0 / 1339	0.17 (1)
U-D	-6976 / 0	-91.8	-91.8	0.24 (1)	4.35	O-E	-1058 / 0	0.13 (1)
D-V	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	O-G	0 / 1339	0.17 (1)
V-W	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	M-G	-1808 / 0	0.19 (1)
W-X	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	M-H	0 / 3021	0.37 (1)
X-E	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	L-H	-449 / 0	0.06 (1)
E-Y	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	B-R	0 / 4585	0.57 (1)
Y-F	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	L-I	0 / 4585	0.57 (1)
F-Z	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02			
Z-AA	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02			
AA-G	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02			
G-AB	-6976 / 0	-91.8	-91.8	0.24 (1)	4.35			
AB-AC	-6976 / 0	-91.8	-91.8	0.24 (1)	4.35			
AC-H	-6976 / 0	-91.8	-91.8	0.24 (1)	4.35			
H-I	-5069 / 0	-91.8	-91.8	0.52 (1)	3.87			
I-J	0 / 28	-91.8	-91.8	0.07 (1)	10.00			
S-B	-3250 / 0	0.0	0.0	0.11 (1)	7.69			
K-I	-3250 / 0	0.0	0.0	0.11 (1)	7.69			

S-AD	0 / 0	-18.5	-18.5	0.07 (4)	10.00
AD-AE	0 / 0	-18.5	-18.5	0.07 (4)	10.00
AE-R	0 / 0	-18.5	-18.5	0.07 (4)	10.00
R-AF	0 / 4557	-18.5	-18.5	0.33 (1)	10.00
AF-AG	0 / 4557	-18.5	-18.5	0.33 (1)	10.00
AG-Q	0 / 4557	-18.5	-18.5	0.33 (1)	10.00
Q-AH	0 / 6975	-18.5	-18.5	0.52 (1)	10.00
AH-P	0 / 6975	-18.5	-18.5	0.52 (1)	10.00
P-AI	0 / 6975	-18.5	-18.5	0.52 (1)	10.00
AI-O	0 / 6975	-18.5	-18.5	0.52 (1)	10.00
O-AJ	0 / 6975	-18.5	-18.5	0.52 (1)	10.00
AJ-N	0 / 6975	-18.5	-18.5	0.52 (1)	10.00
N-AK	0 / 6975	-18.5	-18.5	0.52 (1)	10.00
AK-M	0 / 6975	-18.5	-18.5	0.52 (1)	10.00
M-AL	0 / 4557	-18.5	-18.5	0.33 (1)	10.00
AL-AM	0 / 4557	-18.5	-18.5	0.33 (1)	10.00
AM-L	0 / 4557	-18.5	-18.5	0.33 (1)	10.00
L-AN	0 / 0	-18.5	-18.5	0.07 (4)	10.00
AN-AO	0 / 0	-18.5	-18.5	0.07 (4)	10.00
AO-K	0 / 0	-18.5	-18.5	0.07 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 35.0 PSF
SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBOC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/899 (0.21")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.39")

CSI: TC=0.52/1.00 (B-C:1), EC=0.52/1.00 (O-Q:1), WB=0.57/1.00 (B-R:1), SS=0.16/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.90 (H) (INPUT = 0.80)
JSI METAL= 0.67 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007168 1/2

JOB NAME:	TRUSS NAME:	QUANTITY:	PLY:	JOB DESC.	DRWG NO.
408170	T40	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:15 2020 Page 2
IDK?TPdhai0npi1qYdbWFOFzIdeG-dTolVCBPtkKk qKpGOLn4U0ubv6N8cfVf?sayUzNB1c

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-I	MT20	5.0	8.0		
C	TTWW+m	MT20	5.0	6.0	2.00	2.25
D	TMWW-I	MT20	5.0	6.0		
E	TMWW-w	MT20	3.0	6.0		
F	TS-I	MT20	5.0	6.0		
G	TMWW-I	MT20	5.0	6.0		
H	TTWW+m	MT20	5.0	6.0	2.00	2.25
I	TMWW-I	MT20	5.0	8.0		
K	BMV1+p	MT20	3.0	6.0		
L	BMWW-I	MT20	5.0	6.0	2.50	2.50
M	BMWW-I	MT20	5.0	6.0		
N	BS-I	MT20	5.0	6.0		
O	BMWWWW-I	MT20	5.0	8.0		
P	BS-I	MT20	5.0	6.0		
Q	BMWW-I	MT20	5.0	6.0		
R	BMWW-I	MT20	5.0	6.0	2.50	2.50
S	BMV1+p	MT20	3.0	6.0		

FACTORED CONCENTRATED LOADS (LBS)


JT	LOC	LC1	MAX	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-437	-437	---	FRONT	VERT	TOTAL	---	C1
E	17-7-0	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	29-3-8	-437	-437	---	FRONT	VERT	TOTAL	---	C1
L	29-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
N	21-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
O	17-7-0	-26	-26	---	FRONT	VERT	TOTAL	---	C1
P	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	19-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AE	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	19-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	23-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AL	25-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AM	27-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AN	31-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	33-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007168

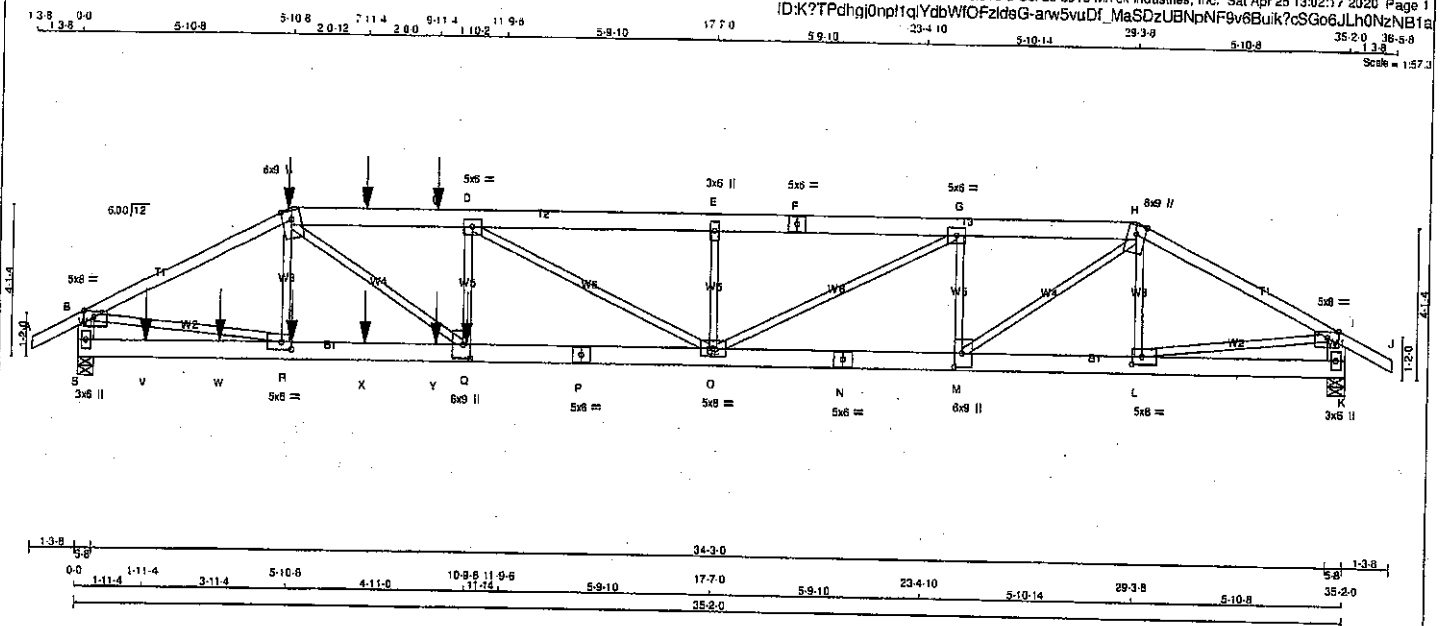

CHORDS	SIZE	LUMBER
A - C	2x4	DRY No.2
C - F	2x6	DRY No.2
F - H	2x4	DRY No.2
H - J	2x4	DRY No.2
J - K	2x6	DRY No.2
K - L	2x6	DRY No.2
L - M	2x6	DRY No.2
M - N	2x6	DRY No.2
N - O	2x6	DRY No.2
O - P	2x6	DRY No.2
P - Q	2x6	DRY No.2
Q - R	2x6	DRY No.2
R - S	2x6	DRY No.2
S - T	2x6	DRY No.2
T - U	2x6	DRY No.2
U - V	2x6	DRY No.2
V - W	2x6	DRY No.2
W - X	2x6	DRY No.2
X - Y	2x6	DRY No.2
Y - Z	2x6	DRY No.2
Z - A	2x6	DRY No.2

ALL WEBS EXCEPT

DRY, SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122'X3') SPIRAL NAILS		
A - C 1	12	SIDE(61.0)
H - J 1	12	TOP
C - F 2	12	SIDE(61.0)
F - H 2	12	TOP
S - B 2	12	TOP
K - I 2	12	TOP
BOTTOM CHORDS: (0.122'X3') SPIRAL NAILS		
S - P 2	12	SIDE(183.1)
P - N 2	12	TOP
N - K 2	12	TOP
WEBS: (0.122'X3') SPIRAL NAILS		
2x3 1	6	SIDE(525.1)
D - Q 1	3	
G - M 1	3	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	UP/LIFT
S	4582	0	4582	0
K	3047	0	3047	0

UNFACTORED REACTIONS

1ST LOOSE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
S	3235	2151 / 0 0 / 0 0 / 0 1094 / 0 0 / 0
K	2151	1435 / 0 0 / 0 0 / 0 715 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.15 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	FORCE (LBS)
FR-TO				FR-TO	
A-B	0 / 28	-91.8 -91.8 0.07 (1)	10.00	R-C	-573 / 0
B-C	-7293 / 0	-91.8 -91.8 0.72 (1)	3.15	C-Q	0 / 4986
C-T	-10549 / 0	-91.8 -91.8 0.34 (1)	3.55	Q-D	-184 / 35
T-U	-10549 / 0	-91.8 -91.8 0.34 (1)	3.55	D-O	-1207 / 0
U-D	-10549 / 0	-91.8 -91.8 0.34 (1)	3.55	O-E	-646 / 0
D-E	-9485 / 0	-91.8 -91.8 0.31 (1)	3.78	E-G	0 / 2871
E-F	-9485 / 0	-91.8 -91.8 0.29 (1)	3.81	M-G	-1894 / 0
F-G	-9485 / 0	-91.8 -91.8 0.29 (1)	3.81	M-H	0 / 3512
G-H	-6956 / 0	-91.8 -91.8 0.17 (1)	4.44	L-H	-464 / 0
H-I	-4808 / 0	-91.8 -91.8 0.48 (1)	4.06	B-R	0 / 6595
I-J	0 / 28	-91.8 -91.8 0.07 (1)	10.00	L-I	0 / 4167
S-B	-4503 / 0	0.0 0.0 0.16 (1)	6.78		
K-I	-2990 / 0	0.0 0.0 0.11 (1)	7.81		
S-V	0 / 0	-18.5 -18.5 0.05 (4)	10.00		
V-W	0 / 0	-18.5 -18.5 0.05 (4)	10.00		
W-R	0 / 0	-18.5 -18.5 0.05 (4)	10.00		
R-X	0 / 6557	-18.5 -18.5 0.50 (1)	10.00		
X-Y	0 / 6557	-18.5 -18.5 0.50 (1)	10.00		
Y-Q	0 / 6557	-18.5 -18.5 0.50 (1)	10.00		
Q-P	0 / 10548	-18.5 -18.5 0.77 (1)	10.00		
P-O	0 / 10548	-18.5 -18.5 0.77 (1)	10.00		
O-N	0 / 6955	-18.5 -18.5 0.50 (1)	10.00		
N-M	0 / 6955	-18.5 -18.5 0.50 (1)	10.00		
M-L	0 / 4144	-18.5 -18.5 0.29 (1)	10.00		
L-K	0 / 0	-18.5 -18.5 0.04 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LOC.	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-437	-437	---	BACK	VERT	TOTAL	---	C1
O	10-9-8	-2715	-2715	---	BACK	VERT	TOTAL	---	C1
R	5-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	1-11-4	-25	-25	---	BACK	VERT	TOTAL	---	C1
W	3-11-4	-25	-25	---	BACK	VERT	TOTAL	---	C1
X	7-11-4	-25	-25	---	BACK	VERT	TOTAL	---	C1
Y	9-11-4	-25	-25	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 169 = 338 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = L/999 (0.28")
ALLOWABLE DEFL.(TL) = L/360 (1.17)
CALCULATED VERT. DEFL.(TL) = L/881 (0.48")

CSI: TO=0.72/1.00 (B-C:1), BC=0.77/1.00 (C-Q:1), WB=0.82/1.00 (B-R:1), SSI=0.13/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSF) (PLF) (PLF)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.99 (P) (INPUT = 1.00)

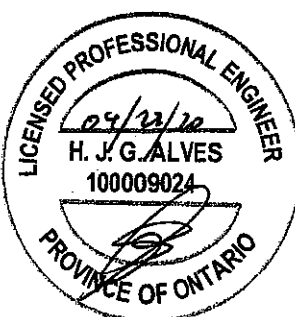

Structural component only
DWG# T-2007169

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T40Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 13:02:17 2020 Page 2
ID:K?TPdhq0npl1qYcbWIOFzIdeG-arw5vuDf_MaSDzUBNpNF9v6Bujik?cSGo6JLh0NzNB1a


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	2.00	3.50
C	TTWW+m	MT20	6.0	9.0	Edge	
D	TMWW-t	MT20	5.0	6.0		
E	TMWW-w	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMWW-l	MT20	5.0	6.0		
H	TTWW+m	MT20	6.0	9.0	Edge	
I	TMVW-p	MT20	5.0	8.0	2.00	3.50
K	BMV1+p	MT20	3.0	6.0		
L	BMWW-l	MT20	5.0	8.0	2.50	3.25
M	BMWW+l	MT20	6.0	9.0	4.50	2.50
N	BS-t	MT20	5.0	6.0		
O	BMWWW-l	MT20	5.0	8.0		
P	BS-t	MT20	5.0	6.0		
Q	BMWW+l	MT20	6.0	9.0	4.50	2.50
R	BMWW-l	MT20	5.0	8.0	2.50	3.25
S	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

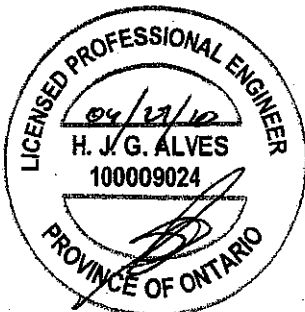


Structural component only
DWG# T-2007169 *3/2*

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T42	2	1	TRUSS DESC.		

Tamarack Pool Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:19 2020 Page 1
ID:K?TPdngj0npl1qlydbWfOFzIdeG-WE2rKaEWwzr9THdaVEQIEKBSUWUW4PP4adco5FzNB1Y

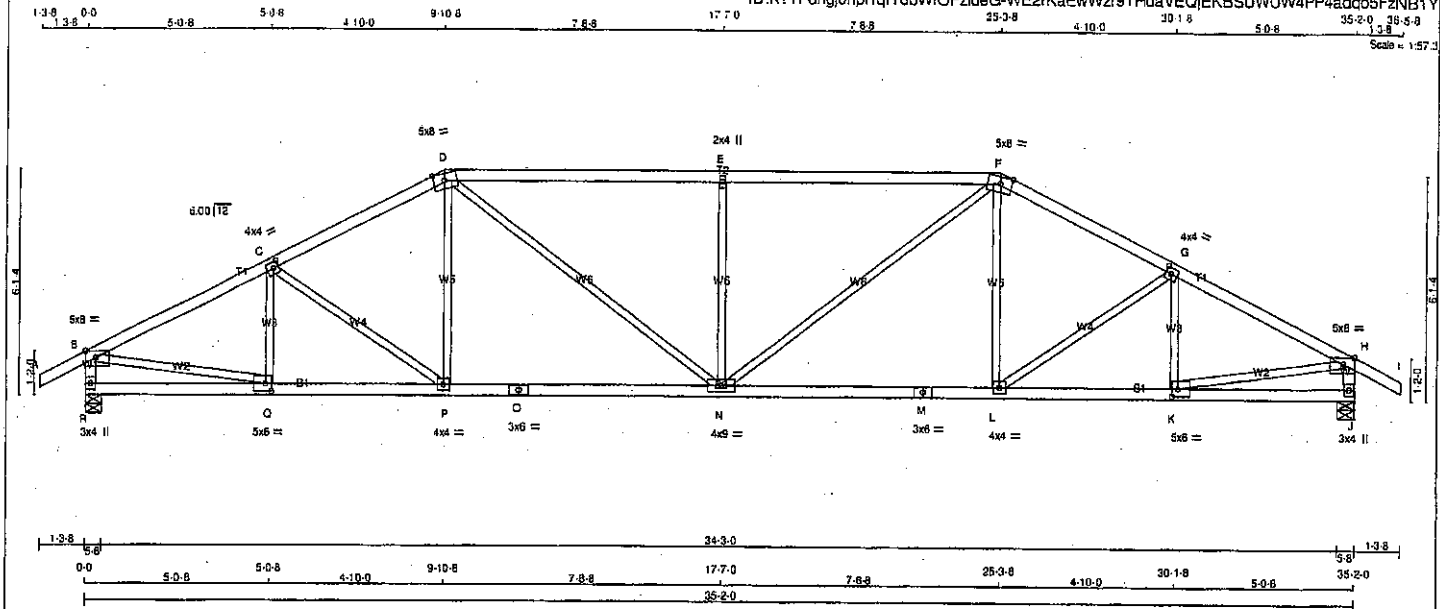

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	Edge 3.50	
C TMVW-l	MT20	4.0	4.0	2.00 1.75	
D TTWW-m	MT20	5.0	8.0	2.25 3.75	
E TMVW-w	MT20	2.0	4.0		
F TTWW-m	MT20	5.0	8.0	2.25 3.75	
G TMVW-l	MT20	4.0	4.0	2.00 1.75	
H TMVW-p	MT20	5.0	8.0	Edge 3.50	
J BMV1-p	MT20	3.0	4.0		
K BMVW-l	MT20	5.0	8.0	2.50 2.00	
L BMVW-l	MT20	4.0	4.0		
M BS-l	MT20	3.0	6.0		
N BMVW-l	MT20	4.0	9.0		
O BS-l	MT20	3.0	6.0		
P BMVW-l	MT20	4.0	4.0		
Q BMVW-l	MT20	5.0	6.0	2.50 2.00	
R BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG			
JT	VERT	HCRZ	DOWN	HCRZ	UPLIFT	IN-SX	IN-SX
R	2063	0	2063	0	0	5-8	5-8
J	2063	0	2063	0	0	5-8	5-8

UNFACTORED REACTIONS							
	1ST LCASE	MAX	MIN	COMPONENT	REACTIONS		
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
J	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.78 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING							
TOTAL LOAD CASES: (4)							
CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1	MAX (FLF) CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	PR-TO
A-B	0 / 28	-91.8	-91.8 0.12 (1)	Q-C	-353 / 0	10.00	0.08 (1)
B-C	-2834 / 0	-91.8	-91.8 0.39 (1)	C-P	-210 / 0	10.00	0.13 (1)
C-D	-2887 / 0	-91.8	-91.8 0.37 (1)	P-D	0 / 246	10.00	0.06 (4)
D-E	-3060 / 0	-91.8	-91.8 0.97 (1)	D-N	0 / 844	10.00	0.19 (1)
E-F	-3060 / 0	-91.8	-91.8 0.97 (1)	N-E	-872 / 0	10.00	0.51 (1)
F-G	-2887 / 0	-91.8	-91.8 0.37 (1)	N-F	0 / 844	10.00	0.19 (1)
G-H	-2834 / 0	-91.8	-91.8 0.39 (1)	L-F	0 / 246	10.00	0.06 (4)
H-I	0 / 28	-91.8	-91.8 0.12 (1)	L-G	-210 / 0	10.00	0.13 (1)
R-B	-2018 / 0	0.0	0.0 0.20 (1)	K-G	-353 / 0	10.00	0.08 (1)
J-H	-2018 / 0	0.0	0.0 0.20 (1)	B-Q	0 / 2591	10.00	0.58 (1)
R-Q	0 / 0	-18.5	-18.5 0.10 (4)	K-H	0 / 2591	10.00	0.58 (1)
Q-P	0 / 2555	-18.5	-18.5 0.51 (1)				
P-O	0 / 2386	-18.5	-18.5 0.49 (1)				
O-N	0 / 2386	-18.5	-18.5 0.49 (1)				
N-M	0 / 2386	-18.5	-18.5 0.49 (1)				
M-L	0 / 2386	-18.5	-18.5 0.49 (1)				
L-K	0 / 2555	-18.5	-18.5 0.51 (1)				
K-J	0 / 0	-18.5	-18.5 0.10 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.17")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.34")

CSI: TC=0.97/1.00 (D-E:1), BC=0.51/1.00 (P-Q:1),
WB=0.58/1.00 (B-Q:1), SS=0.34/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (F) (INPUT = 0.80)
JSI METAL = 0.75 (M) (INPUT = 1.00)

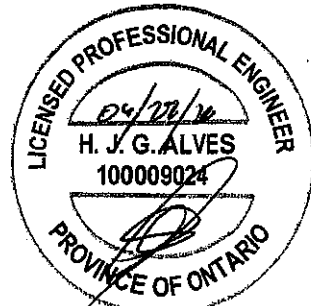


Structural component only
DWG# T-2007171

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T44	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 13:02:21 2020 Page 1
ID:K?TPchj0nph1qYdbWIOFzIdaG-SdAcIGGA2a5libnycISBKiGrDK9jYJhN1xJv98zNB1W

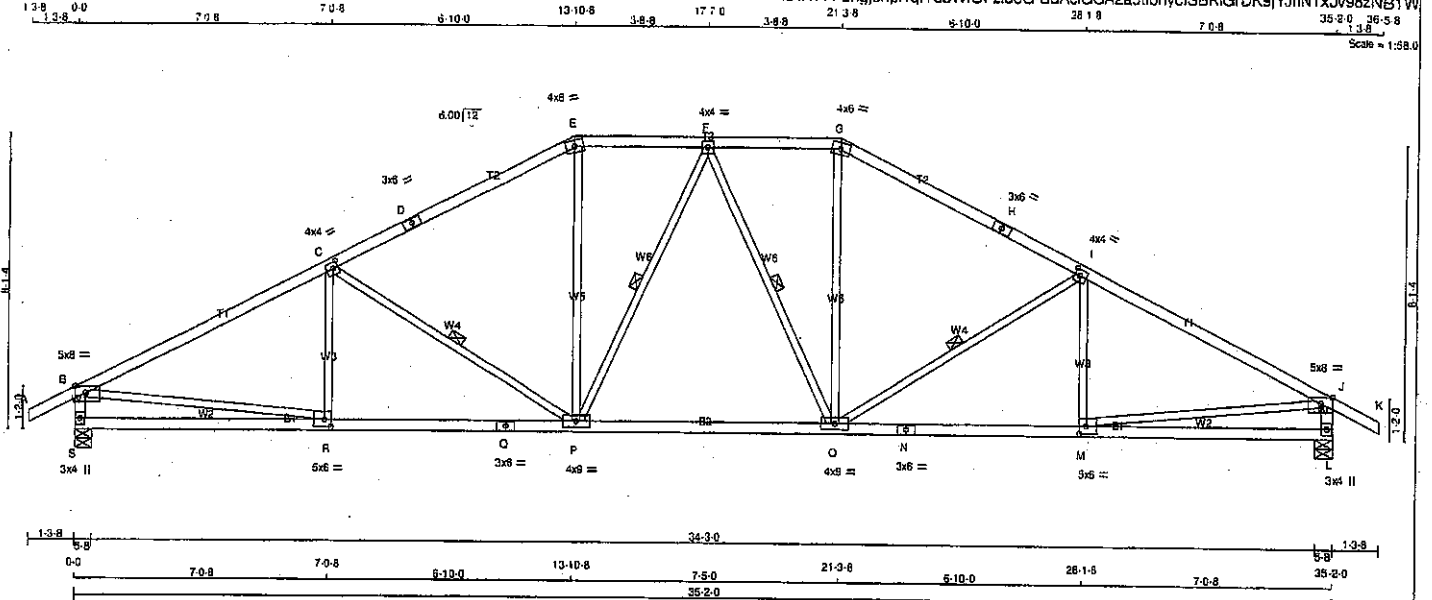

TOTAL WEIGHT = 2 X 145 = 291 lb
[M/F]

LUMBER

N. L. G. A. RULES

CHORDS

SIZE

DRY

LUMBER

DESCR.

SPF

NO.2

ALL WEBS

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE

PLATES

W

LEN

Y

X

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

Edge

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED

GROSS REACTION

MAXIMUM FACTORED

GROSS REACTION

INPUT

REQD

JT

S

L

VERT

HORZ

DOWN

HORZ

UPLIFT

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

IN-SX

UNFACTORED REACTIONS

1ST LCASE

MAX/MIN COMPONENT REACTIONS

JT

S

L

COMBINED

SNOW

LIVE

PERM.LIVE

WIND

DEAD

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

SOIL

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-P, F-P, F-O, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS

MEMB.

FORCE

FACTORED

VERT. LOAD

LC1

MAX

CS1 (LC)

UNBRAC

LENGTH

FR-TO

A-B

B-C

C-D

D-E

E-F

F-G

G-H

H-I

I-J

J-K

K-L

L-M

M-N

N-O

O-P

P-Q

Q-R

R-S

S-T

T-U

U-V

V-W

W-X

X-Y

Y-Z

Z-A

A-B

B-C

C-D

D-E

E-F

F-G

G-H

H-I

I-J

J-K

K-L

L-M

M-N

N-O

O-P

WEBS

MEMB.

FORCE

FACTORED

VERT. LOAD

LC1

MAX

CS1 (LC)

UNBRAC

LENGTH

FR-TO

A-B

B-C

C-D

D-E

E-F

F-G

G-H

H-I

I-J

J-K

K-L

L-M

M-N

N-O

O-P

P-Q

Q-R

R-S

S-T

T-U

U-V

V-W

W-X

X-Y


Y-Z

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T45	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:22 2020 Page 1

ID:K?TPdhqDnpl1qYdbWIOFzldG-wj_zbGopuDKKIM9AMzQsy6jVPhlyXGb2SiazNB1V



LUMBER	SIZE	LUMBER
N. L. G. A. RULES		
CHORDS		
A - D	2x4 DRY	No.2
D - F	2x4 DRY	No.2
F - G	2x4 DRY	No.2
G - I	2x4 DRY	No.2
I - L	2x4 DRY	No.2
L - B	2x4 DRY	No.2
M - K	2x4 DRY	No.2
T - R	2x4 DRY	No.2
R - O	2x4 DRY	No.2
O - M	2x4 DRY	No.2
ALL WEBS EXCEPT	2x3 DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	5.0	6.0	2.50	2.25
D	TS-t	MT20	3.0	6.0		
E	TMWW-t	MT20	4.0	4.0	2.00	1.50
F	TTW-h	MT20	4.0	4.0	2.00	1.75
G	TTWW-m	MT20	5.0	6.0	2.00	2.00
H	TMWW-t	MT20	4.0	4.0	2.00	1.50
I	TS-t	MT20	3.0	6.0		
J	TMWW-t	MT20	5.0	6.0	2.50	2.25
K	TMV+p	MT20	3.0	4.0		
M	BMVW1-t	MT20	5.0	6.0	2.25	2.00
N, P, S						
N	BMWW-t	MT20	4.0	4.0		
O	BS-t	MT20	3.0	6.0		
Q	BMWWW-t	MT20	4.0	9.0		
R	BS-t	MT20	3.0	6.0		
T	BMVW1-t	MT20	5.0	6.0	2.25	2.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
T	VERT	DOWN	0	0
M	HORIZ	UP	0	0

UNFACTORED REACTIONS	1ST CASE	MAX/MIN. COMPONENT REACTIONS
T	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
M		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.85 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, H-P, C-T, J-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO							
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00	C-S	-110/37
B-C	0/19	-91.8	-91.8	0.32 (1)	10.00	S-E	0/276
C-D	-2759/0	-91.8	-91.8	0.40 (1)	3.86	E-Q	-681/0
D-E	-2759/0	-91.8	-91.8	0.40 (1)	3.86	Q-F	0/613
E-F	-2167/0	-91.8	-91.8	0.36 (1)	4.30	F-G	0/4
F-G	-1925/0	-91.8	-91.8	0.18 (1)	4.71	G-H	0/609
G-H	-2188/0	-91.8	-91.8	0.36 (1)	4.30	H-N	-682/0
H-I	-2780/0	-91.8	-91.8	0.40 (1)	3.86	N-J	-110/37
I-J	-2780/0	-91.8	-91.8	0.40 (1)	10.00	J-M	-3040/0
J-K	0/19	-91.8	-91.8	0.32 (1)	10.00	M-K	-3041/0
K-L	0/28	-91.8	-91.8	0.12 (1)	10.00		
L-M	-326/0	0.0	0.0	0.03 (1)	7.81		
M-K	-326/0	0.0	0.0	0.03 (1)	7.81		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT. CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.32")

CSI: TC=0.40/1.00 (H-J:1), BC=0.56/1.00 (M-N:1), WB=0.85/1.00 (J-M:1), SS=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (M) (INPUT = 0.90)
JSI METAL = 0.78 (O) (INPUT = 1.00)



Structural component only
DWG# T-2007174

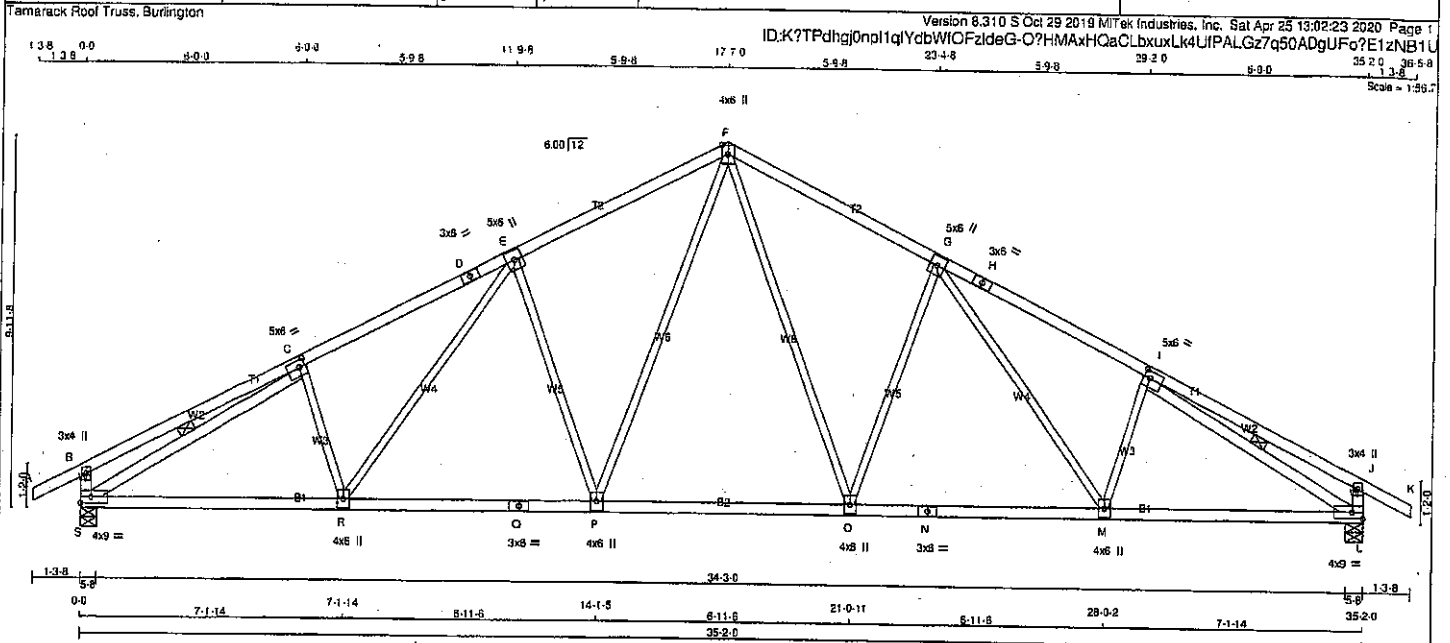

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	DRY	No.2
A - D	2x4	DRY	No.2	
D - F	2x4	DRY	No.2	
F - H	2x4	DRY	No.2	
H - K	2x4	DRY	No.2	
S - B	2x4	DRY	No.2	
L - J	2x4	DRY	No.2	
S - Q	2x4	DRY	No.2	
Q - N	2x4	DRY	No.2	
N - L	2x4	DRY	No.2	
ALL WEBS	2x3	DRY	No.2	
EXCEPT				
S - C	2x4	DRY	No.2	
I - L	2x4	DRY	No.2	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	5.0	8.0	2.25	2.00
D	TS-t	MT20	3.0	8.0		
E	TTWW-t	MT20	5.0	8.0		
F	TTWW+p	MT20	4.0	8.0	Edge	
G	TMWW-t	MT20	5.0	8.0		
H	TS-t	MT20	3.0	8.0		
I	TMWW-t	MT20	5.0	8.0	2.25	2.00
J	TMV+p	MT20	3.0	4.0		
L	BMVW-t	MT20	4.0	9.0	Edge	
M	O, P, R					
N	BMWW-t	MT20	4.0	6.0		
O	BS-t	MT20	3.0	8.0		
Q	BS-t	MT20	3.0	6.0		
S	BMVW-t	MT20	4.0	9.0	Edge	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED			MAXIMUM FACTORED			INPUT	REQD
GROSS REACTION			GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
S	2063	0	2063	0	0	5-8	5-8
L	2063	0	2063	0	0	5-8	5-8

UNFACTORED REACTIONS							
1ST CASE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLP)		MAX. FACTORED CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)
FR-TO			FROM	TO		FR-TO		
A-B	0 / 28		-91.8	-91.8	0.12 (1)	F-O	0 / 866	0.19 (1)
B-C	0 / 22		-91.8	-91.8	0.40 (1)	G-M	-728 / 0	0.72 (1)
C-D	-2808 / 0		-91.8	-91.8	0.49 (1)	H-I	0 / 391	0.09 (1)
D-E	-2808 / 0		-91.8	-91.8	0.49 (1)	I-J	-192 / 18	0.05 (1)
E-F	-2322 / 0		-91.8	-91.8	0.46 (1)	J-K	0 / 866	0.19 (1)
F-G	-2322 / 0		-91.8	-91.8	0.46 (1)	K-L	-728 / 0	0.72 (1)
G-H	-2808 / 0		-91.8	-91.8	0.49 (1)	L-M	0 / 391	0.09 (1)
H-I	-2808 / 0		-91.8	-91.8	0.49 (1)	M-N	-192 / 18	0.05 (1)
I-J	0 / 22		-91.8	-91.8	0.40 (1)	N-O	0 / 866	0.19 (1)
J-K	0 / 28		-91.8	-91.8	0.12 (1)	O-P	-728 / 0	0.72 (1)
K-L	-344 / 0	0.0	0.0	0.0	0.03 (1)	P-Q	0 / 391	0.09 (1)
L-M	-344 / 0	0.0	0.0	0.0	0.03 (1)	Q-R	-192 / 18	0.05 (1)
M-N	0 / 2291	-18.5	-18.5	-18.5	0.53 (1)	R-S	0 / 866	0.19 (1)
N-O	0 / 2291	-18.5	-18.5	-18.5	0.47 (1)	S-T	-728 / 0	0.72 (1)
O-P	0 / 2291	-18.5	-18.5	-18.5	0.47 (1)	T-U	0 / 391	0.09 (1)
P-Q	0 / 1762	-18.5	-18.5	-18.5	0.38 (1)	U-V	-192 / 18	0.05 (1)
Q-R	0 / 2291	-18.5	-18.5	-18.5	0.47 (1)	V-W	0 / 866	0.19 (1)
R-S	0 / 2291	-18.5	-18.5	-18.5	0.47 (1)	W-X	-728 / 0	0.72 (1)
S-T	0 / 2291	-18.5	-18.5	-18.5	0.47 (1)	X-Y	0 / 391	0.09 (1)
T-U	0 / 2291	-18.5	-18.5	-18.5	0.47 (1)	Y-Z	-192 / 18	0.05 (1)
U-V	0 / 2291	-18.5	-18.5	-18.5	0.47 (1)	Z-A	0 / 866	0.19 (1)
V-W	0 / 2291	-18.5	-18.5	-18.5	0.47 (1)	A-B	-728 / 0	0.72 (1)
W-X	0 / 2291	-18.5	-18.5	-18.5	0.47 (1)	B-C	0 / 391	0.09 (1)
X-Y	0 / 2291	-18.5	-18.5	-18.5	0.47 (1)	C-D	-192 / 18	0.05 (1)
Y-Z	0 / 2291	-18.5	-18.5	-18.5	0.47 (1)	D-E	0 / 866	0.19 (1)
Z-A	0 / 2291	-18.5	-18.5	-18.5	0.47 (1)	E-F	-728 / 0	0.72 (1)

TOTAL WEIGHT = 8 X 152 = 910 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 086-14
- TPIG 2011, TPIG 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSI: TC=0.49/1.00 (G-I:1), BC=0.53/1.00 (R-S:1), WB=0.72/1.00 (E-P:1), SS=0.22/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1556

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (C) (INPUT = 0.90)

JSI METAL= 0.77 (I) (INPUT = 1.00)



Structural component only
DWG# T-2007175

CONTINUED ON PAGE 2

JOB NAME 408170	TRUSS NAME T47	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2018 MITek Industries, Inc. Sat Apr 25 13:02:24 2020 Page 2
ID:K?TPdhaI@nplTglYdbWtOFzIdeG-sCrkNH2LVTSZ2WXIn?uxNuSFX8olOpivXZmTzNB1T

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	6.0	1.00	3.00
C	TMWW-t	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	6.0	2.25	2.00
E	TMW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	8.0	2.25	2.00
G	TMVW-t	MT20	5.0	6.0		Edge
H	BMV1+p	MT20	3.0	6.0		
I	BMWW-t	MT20	5.0	6.0	2.50	2.75
J	BMWWW-t	MT20	5.0	8.0		
K	BS-t	MT20	5.0	6.0		
L	BMWW-t	MT20	5.0	6.0		
M	BMWW-t	MT20	5.0	6.0		
N	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

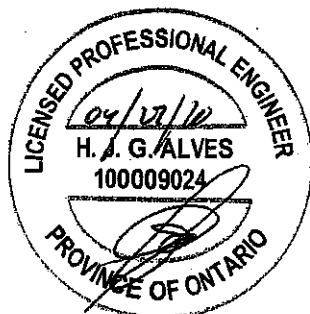


Structural component only
DWG# T-2007176 42

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T48	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITEX Industries, Inc. Sat Apr 25 13:02:25 2020 Page 1
ID:K7TPdhg0npi1qlydbwF0FzIdeG-LOP7bdJg6pbJBC5KUX7UbRc0xZ9U3GzyZH6lvzNB1S

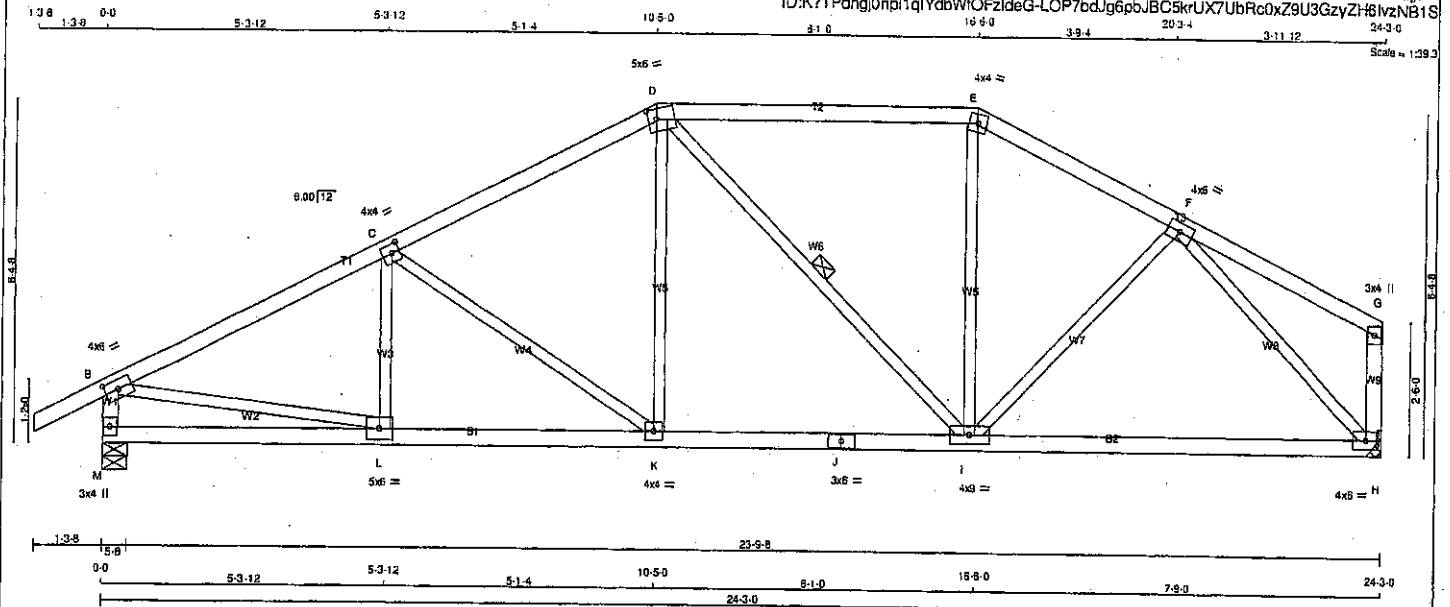

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - G	2x4	DRY	No.2	SPF	
M - B	2x4	DRY	No.2	SPF	
H - G	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-1	MT20	4.0	6.0	2.00	3.00
C TMWW-1	MT20	4.0	4.0	2.00	1.75
D TTWW-m	MT20	5.0	6.0	2.25	2.00
E TTW-m	MT20	4.0	4.0		
F TMWW-1	MT20	4.0	6.0		
G TMV-p	MT20	3.0	4.0		
H BMVW-1	MT20	4.0	6.0		
I BMVWW-1	MT20	4.0	9.0		
J BS-1	MT20	3.0	6.0		
K BMVW-1	MT20	4.0	4.0		
L BMVW-1	MT20	5.0	6.0		
M BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	1461	1461	0	5-8
M	1461	1461	0	5-8
H	1337	1337	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN COMPONENT REACTIONS	SNOW	LIVE	PERMLIVE	WIND	DEAD	SOIL
M	1031	690 / 0	0 / 0	0 / 0	0 / 0	0 / 0	341 / 0	0 / 0
H	945	620 / 0	0 / 0	0 / 0	0 / 0	0 / 0	325 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-I.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LCI	MAX	MAX.	MEMB.	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	FROM	TO	CSI (LC)	UNBRACED LENGTH	FR-TO	FORCE (LBS)	MAX	CSI (LC)
FR-TO										
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	L-C	-165 / 32	0.04 (1)		
B-C	-1844 / 0	-91.8	-91.8	0.36 (1)	4.58	C-K	-438 / 0	0.31 (1)		
C-D	-1488 / 0	-91.8	-91.8	0.34 (1)	5.00	K-D	0 / 394	0.08 (1)		
D-E	-1181 / 0	-91.8	-91.8	0.46 (1)	5.27	D-I	-189 / 0	0.09 (1)		
E-F	-1335 / 0	-91.8	-91.8	0.18 (1)	5.42	I-E	0 / 175	0.05 (4)		
F-G	0 / 18	-91.8	-91.8	0.21 (1)	10.00	I-F	0 / 158	0.04 (4)		
M-B	-1419 / 0	0.0	0.0	0.14 (1)	6.85	B-L	0 / 1692	0.38 (1)		
H-G	-130 / 0	0.0	0.0	0.02 (1)	7.81	F-H	-1563 / 0	0.82 (1)		
M-L	0 / 0	-18.5	-18.5	0.12 (4)	10.00					
L-K	0 / 1671	-18.5	-18.5	0.32 (1)	10.00					
K-J	0 / 1313	-18.5	-18.5	0.38 (4)	10.00					
J-I	0 / 1313	-18.5	-18.5	0.38 (4)	10.00					
I-H	0 / 1069	-18.5	-18.5	0.34 (4)	10.00					

TOTAL WEIGHT = 99 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.81")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.46/1.00 (D-E:1), BC=0.36/1.00 (I-K:4), WB=0.82/1.00 (F-H:1), SSI=0.22/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1867 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.50 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007177

Tamarack Roof Truss, Burlington

ID:K?TPdhg1qYdbWfOFZdaG-HnX10JKxeQr1QWF6zvZb20Wx4kDry?IGPmDNzNB1C

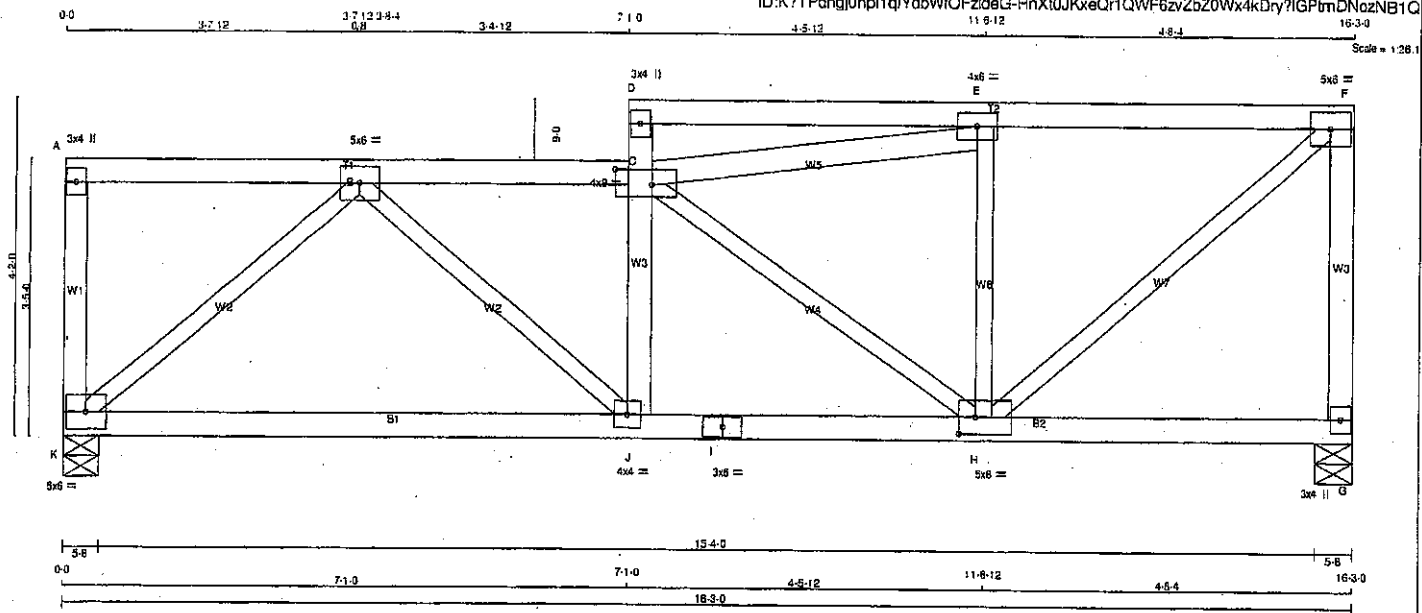

TOTAL WEIGHT = 3 X 72 = 216 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
K - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
J - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
G - F	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT	2x4	DRY	No.2
C - E	2x4	DRY	No.2

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMV-p	MT20	3.0	4.0	
B	TMVW-t	MT20	5.0	6.0	
C	TMVW-t	MT20	4.0	9.0	2.25 5.50
D	TMV-p	MT20	3.0	4.0	
E	TMVW-t	MT20	4.0	6.0	
F	TMVW-t	MT20	5.0	6.0	
G	BMV1-p	MT20	3.0	4.0	
H	BMVW-t	MT20	5.0	8.0	2.50 2.50
I	BS-t	MT20	3.0	6.0	
J	BMVW-t	MT20	4.0	4.0	
K	BMVW-t	MT20	5.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING

BEARINGS							
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
K	1079	0	1079	0	0	5-8	5-8
G	1079	0	1079	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE MAX./MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	780	416 / 0	0 / 0	0 / 0	0 / 0	364 / 0	0 / 0
G	780	416 / 0	0 / 0	0 / 0	0 / 0	364 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. FACTORED UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (LC)	
FR-TO				FR-TO			
K-A	-183 / 0	0.0	0.0 0.04 (1)	7.81	K-B	-1328 / 0	0.65 (1)
A-B	0 / 0	-114.3	-114.3 0.32 (1)	10.00	B-J	0 / 538	0.18 (1)
B-C	-1416 / 0	-114.3	-114.3 0.37 (1)	4.47	C-E	-961 / 0	0.30 (1)
J-C	-226 / 0	0.0	0.0 0.08 (1)	7.81	C-H	-489 / 0	0.30 (1)
C-D	-183 / 0	0.0	0.0 0.08 (1)	7.81	H-E	-471 / 0	0.16 (1)
D-E	-58 / 0	-114.3	-114.3 0.51 (1)	6.25	E-F	0 / 1303	0.39 (1)
E-F	-1004 / 0	-114.3	-114.3 0.55 (1)	4.81			
G-F	-1039 / 0	0.0	0.0 0.37 (1)	6.51			
K-J	0 / 1013	-18.5	-18.5 0.41 (4)	10.00			
J-I	0 / 1402	-18.5	-18.5 0.48 (4)	10.00			
I-H	0 / 1402	-18.5	-18.5 0.48 (4)	10.00			
H-G	0 / 0	-18.5	-18.5 0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 15.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 48.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL PLATE SECTIONS BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 089-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/989 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/989 (0.11")

CSI: TC=0.55/1.00 (E-F:1), BC=0.48/1.00 (H-J:4), WB=0.55/1.00 (B-K:1), SS=0.34/1.00 (E-F:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
	768	1987	1655


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (C) (INPUT = 0.90)
JSI METAL= 0.82 (I) (INPUT = 1.00)



Structural component only
DWG# T-2007178

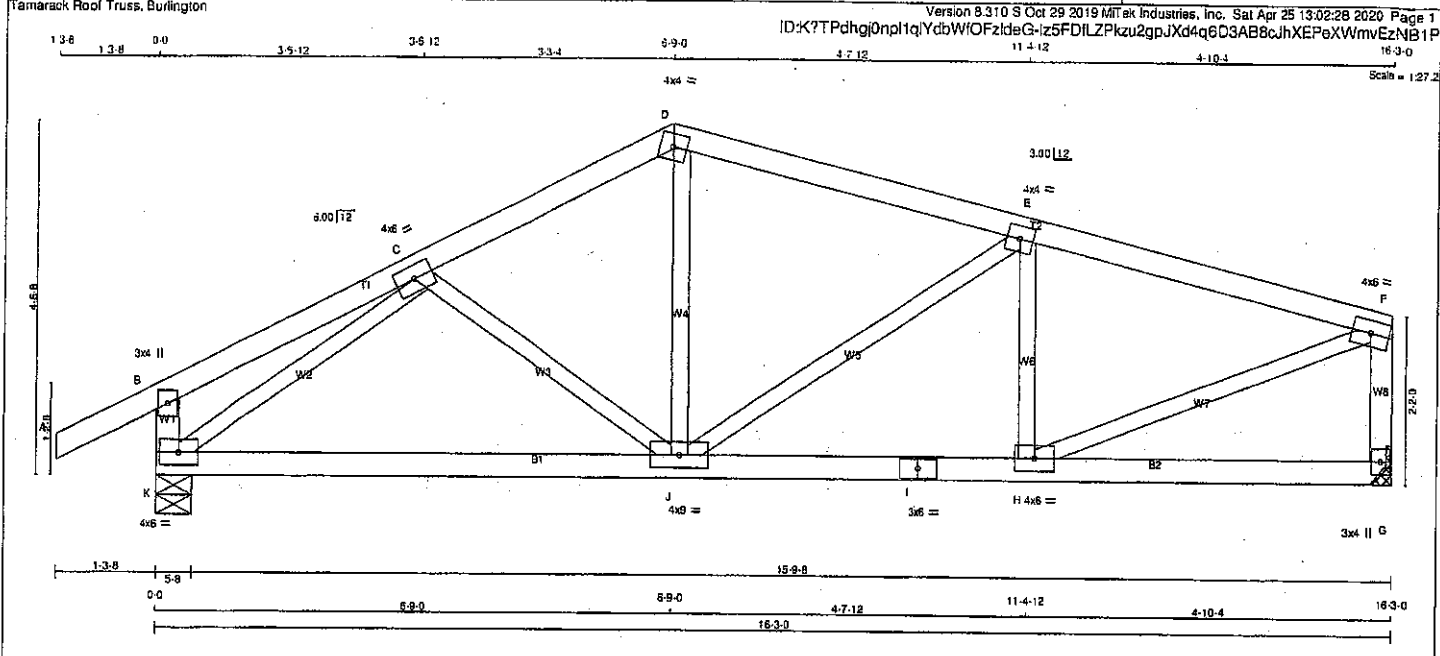

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:28 2020 Page 1
ID:K7TPdhg0npl1qYdbWIOFzIdeG-lz5FDILZPkzu2gpJXd4q6D3ABBcjhXEPeXWmvEzNB1P
Tamarack Roof Truss, Burlington
Scale = 1/2\"/>

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D	SPECIFIED LOADS:	
A - D	2x4	DRY	No.2	SPF	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	REQ'D	TOP CH. LL = 25.6 PSF	
D - F	2x4	DRY	No.2	SPF	JT	VERT	HORZ	DOWN	HORZ	DL = 6.0 PSF	
K - B	2x4	DRY	No.2	SPF	K	1020	0	1020	0	BOT CH. LL = 0.0 PSF	
G - F	2x4	DRY	No.2	SPF	G	896	0	896	0	DL = 7.4 PSF	
K - I	2x4	DRY	No.2	SPF						TOTAL LOAD = 39.0 PSF	
I - G	2x4	DRY	No.2	SPF							
ALL WEBS	2x3	DRY	No.2	SPF	A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.				SPACING = 24.0 IN. O.C.		
EXCEPT											

DRY, SEASONED LUMBER. TOTAL WEIGHT = 2 X 63 = 126 lb

<u>PLATES (table is in inches)</u>					K	719	485/0	0/0	0/0	0/0	234/0	0/0	UNFACTORED REACTIONS WITH: - PART 8 OF CBC 2018, CBC 2012, ABC 2018 - PART 8 OF CBC 2012 (2019 AMENDMENT) - CSA 086-09, CSA 086-14 - TPIC 2011, TPIC 2014
JT	TYPE	PLATES	W	LEN Y X	G	633	416/0	0/0	0/0	0/0	218/0	0/0	
B	TMV+p	MT20	3.0	4.0	BRACING								(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD
C	TMVW-i	MT20	4.0	6.0	TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.73 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.								
D	TTW-i	MT20	4.0	4.0	ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.								ALLOWABLE DEFL.(LL)= L/360 (0.54") CALCULATED VERT. DEFL.(LL)= L/999 (0.03") ALLOWABLE DEFL.(TL)= L/360 (0.54") CALCULATED VERT. DEFL.(TL)= L/999 (0.09")
E	TMVW-i	MT20	4.0	4.0	<u>LOADING</u>								
F	TMVW-i	MT20	4.0	6.0	TOTAL LOAD CASES: (4)								
G	BMV1+p	MT20	3.0	4.0									
H	BMVW-i	MT20	4.0	6.0									
I	BS-i	MT20	3.0	6.0									
J	BMVW-i	MT20	4.0	9.0									
K	BMVW-i	MT20	4.0	6.0									

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/28	-91.8 -91.8	0.12 (1)	C-J	-135/7	0.04 (1)	
B-C	0/14	-91.8 -91.8	0.15 (1)	J-D	0/355	0.08 (1)	
C-D	-862/0	-91.8 -91.8	0.13 (1)	D-E	-263/0	0.13 (1)	
D-E	-894/0	-91.8 -91.8	0.20 (1)	E-F	-335/0	0.07 (1)	
E-F	-1094/0	-91.8 -91.8	0.27 (1)	F-G	-1196/0	0.35 (1)	
F-G	-248/0	0.0 0.0	0.03 (1)	G-H	0/1150	0.25 (1)	
G-H	-855/0	0.0 0.0	0.10 (1)				
K-J	0/956	-18.5 -18.5	0.26 (1)				
J-I	0/1073	-18.5 -18.5	0.27 (1)				
I-H	0/1073	-18.5 -18.5	0.27 (1)				
H-G	0/0	-18.5 -18.5	0.10 (4)				

Structural component only
DWG# T-2007179

ALLOWABLE DEFL. (LL) = L/360 (0.54")
CALCULATED VERT. DEFL. (LL) = L/999 (0.03")
ALLOWABLE DEFL. (TL) = L/360 (0.54")
CALCULATED VERT. DEFL. (TL) = L/999 (0.09")

CSI: TC=0.27/1.00 (E-F:1), BC=0.27/1.00 (H-J:1),
WB=0.35/1.00 (C-K:1), CSI=0.21/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656


PLATE PLACEMENT TOL = 0.250 inches
PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.71 (H) (INPUT = 0.90)
JSI METAL= 0.32 (I) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408170	T51	1	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:29 2020 Page 1
ID:K7TPdhg0npl1qYdbWfOfZdeG-D9fdR?MBA25lfpOV4Kb3eRbKcYx2GzGZ1BfKSGzNB1C

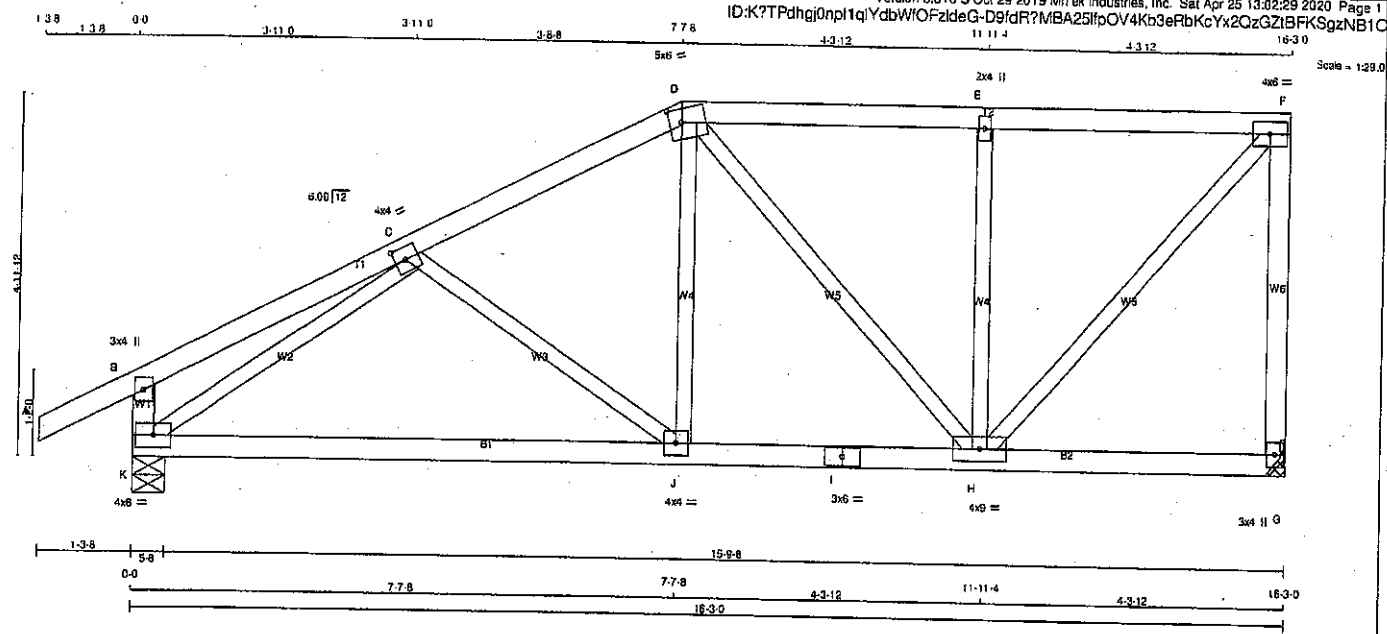

LUMBER				DESCR.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY				TOTAL WEIGHT = 70 lb			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	SPF	FACTORED	MAXIMUM FACTORED	INPUT	REQRD	BEARINGS	BEARINGS	BEARINGS	BEARINGS	BEARINGS	BEARINGS	BEARINGS
A - D	2x4	DRY	No.2	SPF	GROSS REACTION	GROSS REACTION	BRG	BRG	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
D - F	2x4	DRY	No.2	SPF	G	896	0	896	0	0	0	0	0	0	MECHANICAL
G - F	2x4	DRY	No.2	SPF	K	1020	0	1020	0	0	0	0	0	0	5-8
K - B	2x4	DRY	No.2	SPF											
K - I	2x4	DRY	No.2	SPF											
I - G	2x4	DRY	No.2	SPF											
ALL WEBS	2x3	DRY	No.2	SPF											
EXCEPT															
DRY: SEASONED LUMBER.															

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
C	TMWW-I	MT20	4.0	4.0	2.00 1.75
D	TTWW-m	MT20	5.0	6.0	2.25 2.00
E	TMW-w	MT20	2.0	4.0	
F	TMW-I	MT20	4.0	6.0	
G	BMV1+p	MT20	3.0	4.0	
H	BMWW-I	MT20	4.0	9.0	
I	BS-I	MT20	3.0	6.0	
J	BMWW-I	MT20	4.0	4.0	
K	BMVW1-I	MT20	4.0	8.0	

UNFACTORED REACTIONS						
1ST CASE	MAX/MIN	COMPONENT	REACTIONS			
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
G	633	416 / 0	0 / 0	0 / 0	0 / 0	218 / 0
K	719	485 / 0	0 / 0	0 / 0	0 / 0	234 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.21 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (LC)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (LC)	MAX. UNBRACED LENGTH (FT)
FR-TO					FR-TO				
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	C-J	-215 / 0	0.08 (1)	0.08 (1)	10.00
B-C	0 / 17	-91.8	-91.8 0.20 (1)	10.00	J-D	0 / 268	0.08 (1)	0.08 (1)	10.00
C-D	-901 / 0	-91.8	-91.8 0.22 (1)	6.21	D-H	-210 / 0	0.14 (1)	0.14 (1)	10.00
D-E	-854 / 0	-91.8	-91.8 0.28 (1)	6.25	H-E	-488 / 0	0.18 (1)	0.18 (1)	10.00
E-F	-854 / 0	-91.8	-91.8 0.28 (1)	6.25	H-F	0 / 961	0.22 (1)	0.22 (1)	10.00
G-F	-858 / 0	0.0	0.0 0.35 (1)	7.81	K-C	-1192 / 0	0.43 (1)	0.43 (1)	10.00
K-B	-261 / 0	0.0	0.0 0.03 (1)	7.81					
K-J	0 / 965	-18.5	-18.5 0.30 (4)	10.00					
J-I	0 / 796	-18.5	-18.5 0.30 (4)	10.00					
I-H	0 / 796	-18.5	-18.5 0.30 (4)	10.00					
H-G	0 / 0	-18.5	-18.5 0.08 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")

CALCULATED VERT. DEFL.(LL) = L/999 (0.02")

ALLOWABLE DEFL.(TL) = L/360 (0.54")

CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.35/1.00 (F-G:1), BC=0.30/1.00 (J-K:4), WB=0.43/1.00 (C-K:1), SSI=0.19/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE GRIP(DRY)	SHEAR	SECTION	(PSI)	(PL)	(PL)
MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1657	788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.86 (C) (INPUT = 0.90)

JSI METAL = 0.40 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007180

Tamarack Roof Truss, Burlington



JSI GRIP= 0.17 (8) (INPUT = 0.90)
JSI METAL= 0.07 (K) (INPUT = 1.00)




Structural component only
DWG# T-2007166

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T53S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:30 2020 Page 1
ID:K?TPchgi0np1q1YcbW/OFzIdeG-hLC0eLNpxLDcHzzhe26IBe8YnyLF8WNI5r?1_7zNB1N

Scale = 1/28.0

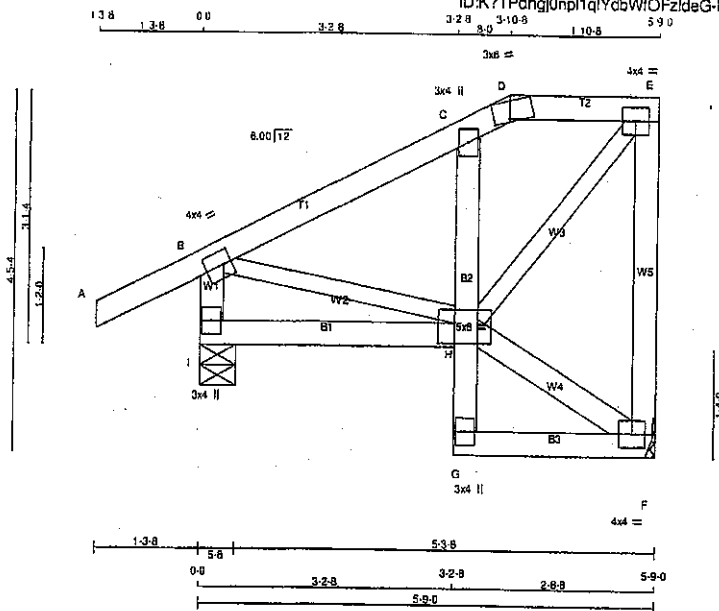

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2	
D - E	2x4	DRY	No.2	
F - E	2x4	DRY	No.2	
I - B	2x4	DRY	No.2	
I - H	2x4	DRY	No.2	
G - C	2x4	DRY	No.2	
G - F	2x4	DRY	No.2	
ALL WEBS EXCEPT	2x4	DRY	No.2	
B - H	2x3	DRY	No.2	
H - E	2x3	DRY	No.2	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B - TMVW-1	MT20	4.0	4.0	2.00	1.25	
C - TMV+p	MT20	3.0	4.0			
D - TT-m	MT20	3.0	6.0	0.50	2.50	
E - TMVW-1	MT20	4.0	4.0			
F - BMVW1-1	MT20	4.0	4.0			
G - BMV+p	MT20	3.0	4.0			
H - BMVWW-1	MT20	5.0	8.0	3.00	2.50	
I - BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	DOWN	BRG	BRG
JT	VERT	DOWN	IN-SX	IN-SX
F	302	0	0	MECHANICAL
I	457	0	457	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS							
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	214	138 / 0	0 / 0	0 / 0	0 / 0	75 / 0	0 / 0
F	320	225 / 0	0 / 0	0 / 0	0 / 0	95 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 / 28	-91.8 -91.8 0.12 (1)	H-F	-10 / 0
B-C	-217 / 0	-91.8 -91.8 0.14 (1)	B-H	0 / 153
C-D	-200 / 0	-91.8 -91.8 0.05 (1)	H-E	0 / 247
D-E	-167 / 0	-91.8 -91.8 0.03 (1)		
F-E	-273 / 0	0.0 0.0 0.03 (1)		
I-B	-420 / 0	0.0 0.0 0.04 (4)		
I-H	0 / 41	-18.5 -18.5 0.05 (4)		
G-H	0 / 25	0.0 0.0 0.02 (1)		
H-C	-186 / 0	0.0 0.0 0.04 (1)		
G-F	0 / 16	-18.5 -18.5 0.02 (4)		

TOTAL WEIGHT = 33 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TRC 2011, TRC 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (B-C:1), BC=0.05/1.00 (H-I:4), WB=0.06/1.00 (E-H:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 798 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.36 (H) (INPUT = 0.90)
JSI METAL= 0.13 (B) (INPUT = 1.00)

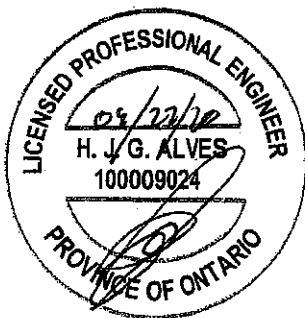


Structural component only
DWG# T-2007181

JOB NAME 408170	TRUSS NAME T54S	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 2019 MTek Industries, Inc. Sat Apr 25 13:02:31 2020 Page 1
ID:K?TPdhqI0npl1qYdbWOFzdeG-9YmOrgNRhLTv7YiCleXkshknMhguyRrKvKRWZzNB1M

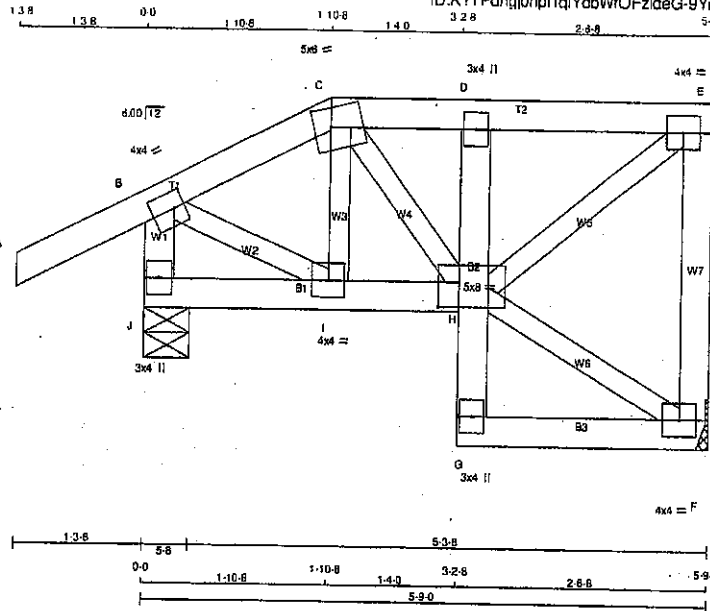

Scale = 1/2" = 1'-0"

LUMBER

N. L. G. A. RULES	SIZE	LUMBER
CHORDS		
A - C	2x4 DRY	No.2
C - E	2x4 DRY	No.2
F - B	2x4 DRY	No.2
J - H	2x4 DRY	No.2
G - D	2x4 DRY	No.2
G - F	2x4 DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	4.0	2.00	1.25
C	TTWW-m	MT20	5.0	6.0	2.25	2.00
D	TMV+p	MT20	3.0	4.0		
E	TMVW-t	MT20	4.0	4.0		
F	BMVW1-t	MT20	4.0	4.0		
G	BMV+p	MT20	3.0	4.0		
H	BVMVWW-t	MT20	5.0	8.0	3.00	2.50
I	BMVW-t	MT20	4.0	4.0		
J	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

DESCR.	SPF	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	SPF	VERT	DOWN	IN-SX	IN-SX
F	SPF	302	0	0	0
J	SPF	458	0	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	214	139 / 0	0 / 0	0 / 0	0 / 0	75 / 0	0 / 0
J	320	225 / 0	0 / 0	0 / 0	0 / 0	95 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)
FR-TO									
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	I-C	-50 / 10	0.01 (1)	
B-C	-240 / 0	-91.8	-91.8	0.12 (1)	6.25	C-H	0 / 84	0.02 (1)	
C-D	-246 / 0	-91.8	-91.8	0.05 (1)	6.25	H-F	-9 / 0	0.00 (1)	
D-E	-241 / 0	-91.8	-91.8	0.07 (1)	6.25	H-E	0 / 302	0.07 (1)	
F-E	-278 / 0	0.0	0.0	0.05 (1)	7.81	B-I	0 / 214	0.05 (1)	
J-B	-439 / 0	0.0	0.0	0.04 (1)	7.81				
J-I	0 / 0	-18.5	-18.5	0.02 (4)	10.00				
I-H	0 / 193	-18.5	-18.5	0.04 (1)	10.00				
G-H	0 / 25	0.0	0.0	0.02 (1)	10.00				
H-D	-218 / 0	0.0	0.0	0.01 (1)	7.81				
G-F	0 / 8	-18.5	-18.5	0.03 (4)	10.00				

TOTAL WEIGHT = 31 b

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (H-I:1), WB=0.07/1.00 (E-H:1), SSI=0.10/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.33 (B) (INPUT = 0.50)
JSI METAL= 0.13 (B) (INPUT = 1.00)

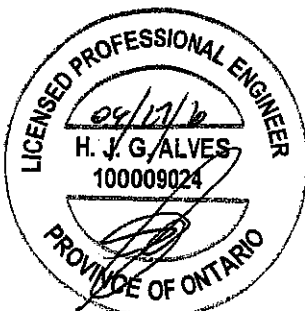

Structural component only
DWG# T-2007182

Tamarack Roof Truss, Burlington



PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-I	MT20	4.0	4.0	2.00	1.25
B	TMVW-t	MT20	4.0	4.0	2.00	1.75
C	TMV+p	MT20	3.0	4.0		
D	BMVW1+p	MT20	4.0	6.0		
E	BMVW-1	MT20	5.0	6.0		

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

JSI GRIP= 0.72 (A) (INPUT = 0.90)
JSI METAL= 0.18 (D) (INPUT = 1.00)




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC	DRWG NO.
408170	T55	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 13:02:32 2020 Page 2
ID:K?TPdHgJ0npJ1qYdWIOFzdeG-dkKm30Q3SzTJWH74mT9mG3DvHl 9dNX?Z9U 27zNB1L

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
F	BMV1+p	MT20	3.0	6.0		

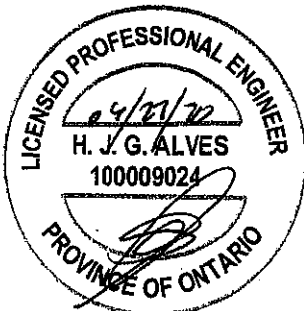


Structural component only
DWG# T-2007183

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC	GREEN PARK HOMES	DRWG NO.
408170	T56	1	2	TRUSS DESC.		

Tamarack Root Truss, Burlington

Version 6.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:33 2020 Page 1

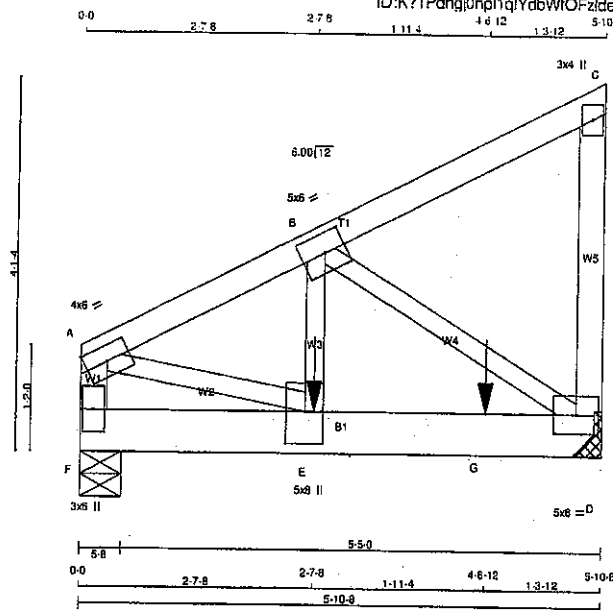

Scale = 1/2" = 1'-0"

CHORDS	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES				
F - A	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
F - D	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY
DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F - A 1 12		TOP
A - C 1 12		TOP
C - D 1 12		TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D 2 5		SIDE (549.3)
WEBS : (0.122"x3") SPIRAL NAILS		
B - E 1 2		SIDE (259.5)
2x3 1 5		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	4.0	6.0		Edge
B	TMVW-1	MT20	5.0	6.0	2.50	2.75
C	TMVW-1	MT20	3.0	4.0		
D	BMVW-1	MT20	5.0	5.0		
E	BMVW-1	MT20	5.0	5.0	4.25	2.50

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
F	2334	0	2334	0
D	2733	0	2733	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4'-0".

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	1846	1103 / 0	0 / 0	0 / 0	0 / 0	0 / 0	543 / 0	0 / 0
D	1929	1290 / 0	0 / 0	0 / 0	0 / 0	0 / 0	639 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)	MAX. FACTORED VERT. LOAD (LC4)	MAX. FACTORED VERT. LOAD (LC5)	MAX. FACTORED VERT. LOAD (LC6)	MAX. FACTORED VERT. LOAD (LC7)	MAX. FACTORED VERT. LOAD (LC8)	MAX. FACTORED VERT. LOAD (LC9)	MAX. FACTORED VERT. LOAD (LC10)
F-A	-2316 / 0	0.0	0.0	0.13 (1)	7.37	A-E	0 / 2898	0.36 (1)				
A-B	-3101 / 0	-91.8	-91.8	0.08 (1)	5.20	E-B	0 / 2800	0.35 (1)				
B-C	-5 / 0	-91.8	-91.8	0.08 (1)	10.00	B-D	-3303 / 0	0.42 (1)				
D-C	-138 / 0	0.0	0.0	0.02 (1)	7.81							
F-E	0 / 0	-18.5	-18.5	0.01 (4)	10.00							
E-G	0 / 2779	-18.5	-18.5	0.57 (1)	10.00							
G-D	0 / 2779	-18.5	-18.5	0.57 (1)	10.00							

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	2-7-8	-3101	-3101	---	BACK	VERT	TOTAL	---	C1
G	4-6-12	-1318	-1318	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 29 = 57 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (LL) = $L/899$ (0.02")
ALLOWABLE DEFL. (TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (TL) = $L/998$ (0.04")

CSI: TC=0.13/1.00 (A-F:1), BC=0.57/1.00 (D-E:1), WB=0.42/1.00 (B-D:1), SS=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788
	1937	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (E) (INPUT = 0.90)
JSI METAL = 0.50 (E) (INPUT = 1.00)

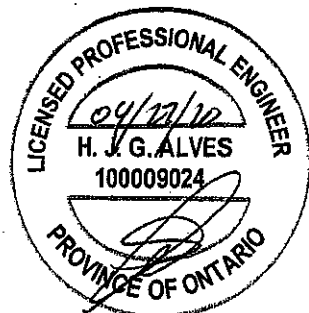


Structural component only
DWG# T-2007184 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC	DRWG NO.
408170	T56	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			


Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 13:02:33 2020 Page 2
ID:K?TPdngi0np1gYdbWICFzdeG-6wu8GMPIDGbA8RiGJAq7pHm499FsMnS8opDXbRzNG1K

PLATES (table is in inches)
JT TYPE PLATES W LEN Y X
F BMV1+p MT20 3.0 6.0
Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

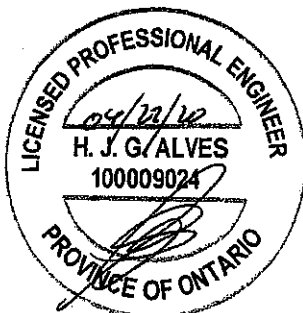


Structural component only
DWG# T-2007184 72

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	PB1	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 12:34:46 2020 Page 1					
ID:DMCubINVR6TstFoe31v6l_zns11-PDfyPME2p5aifFmuAaG4kD6hBP9Gw7nTyvpaZzNBRN					
Scale = 1:23.0					

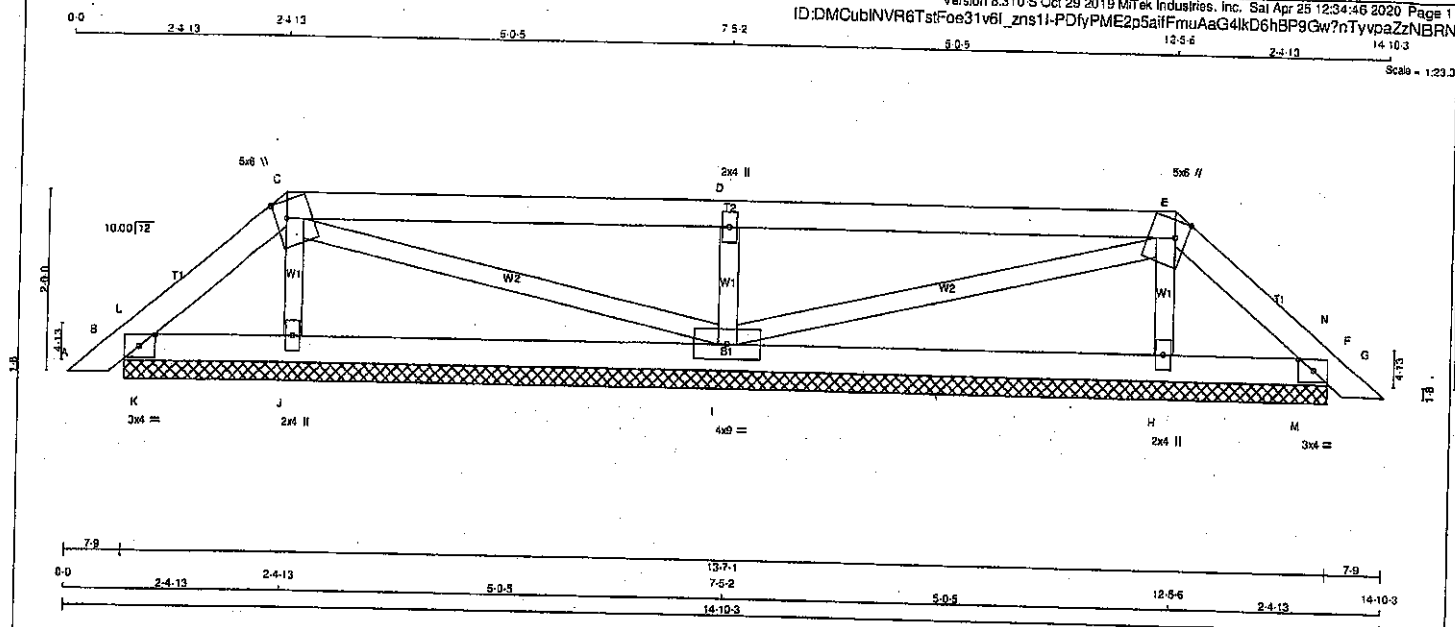

JOB NAME 408169	TRUSS NAME PB20	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:22 2020 Page 1
ID:K?TPdngj0nplqYbbWlOFzldG-mib6FuqXVexPlkFUJ_VFTVTlPKW7jivF6AJozNBDh

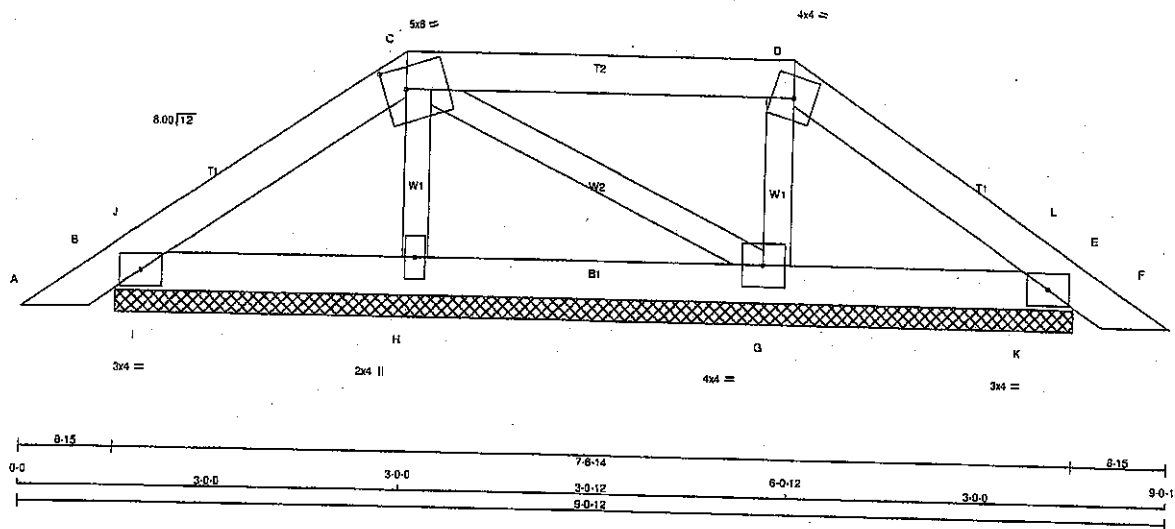

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - D	2x4	DRY No.2	SPF
D - E	2x4	DRY No.2	SPF
B - E	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMB1-I	MT20	3.0	4.0		
C TTWW-m	MT20	5.0	6.0	2.00	2.00
D TTWW-m	MT20	4.0	4.0		
E TMB1-I	MT20	3.0	4.0		
G BMWW1-I	MT20	4.0	4.0		
H BMW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD IN-SX	RECORD IN-SX
	VERT	HORZ	DOWN	HORZ			
B	221	0	221	0	7-6-14	7-6-14	
E	209	0	209	0	7-6-14	7-6-14	
H	248	0	248	0	7-6-14	7-6-14	
G	280	0	280	0	7-6-14	7-6-14	

UNFACTORED REACTIONS

JT	1ST CASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
B	154	113 / 0	0 / 0	0 / 0	0 / 0	41 / 0	0 / 0
E	146	106 / 0	0 / 0	0 / 0	0 / 0	39 / 0	0 / 0
H	178	109 / 0	0 / 0	0 / 0	0 / 0	67 / 0	0 / 0
G	198	127 / 0	0 / 0	0 / 0	0 / 0	71 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 15	-91.8 -91.8	0.03 (1)	10.00	H-C	-176 / 0	0.03 (1)
B-J	-63 / 0	-91.8 -91.8	0.01 (1)	6.25	C-G	-21 / 0	0.00 (1)
J-C	-74 / 0	-91.8 -91.8	0.05 (1)	6.25	G-D	-198 / 0	0.03 (1)
C-D	-30 / 0	-91.8 -91.8	0.15 (1)	6.25	I-J	-121 / 0	0.00 (1)
D-L	-54 / 0	-91.8 -91.8	0.05 (1)	6.25	K-L	-123 / 0	0.00 (1)
L-E	-41 / 0	-91.8 -91.8	0.01 (1)	6.25			
E-F	0 / 15	-91.8 -91.8	0.03 (1)	10.00			
B-I	0 / 60	-18.5 -18.5	0.06 (1)	10.00			
I-H	0 / 60	-18.5 -18.5	0.06 (1)	10.00			
H-G	0 / 48	-18.5 -18.5	0.03 (1)	10.00			
G-K	0 / 43	-18.5 -18.5	0.06 (1)	10.00			
K-E	0 / 43	-18.5 -18.5	0.06 (1)	10.00			

TOTAL WEIGHT = 3 X 25 = 75 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.15/1.00 (C-D:1), BC=0.06/1.00 (B-I:1), WB=0.03/1.00 (D-G:1), SSI=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1657 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.18 (B) (INPUT = 0.90)
JSI METAL = 0.04 (B) (INPUT = 1.00)

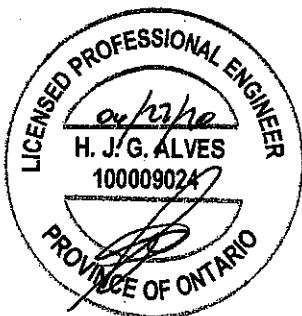


Structural component only
DWG# T-2007144

JOB NAME: 408168	TRUSS NAME: J1	QUANTITY: 19	PLY: 1	JOB DESC.: GREEN PARK HOMES	DRWG NO.:
---------------------	-------------------	-----------------	-----------	--------------------------------	-----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 26 12:34:43 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-7e_pnKBAC7001JURIN76ba9zNy3aYKn_h9zEzNBRQ

Scale = 1/22.9

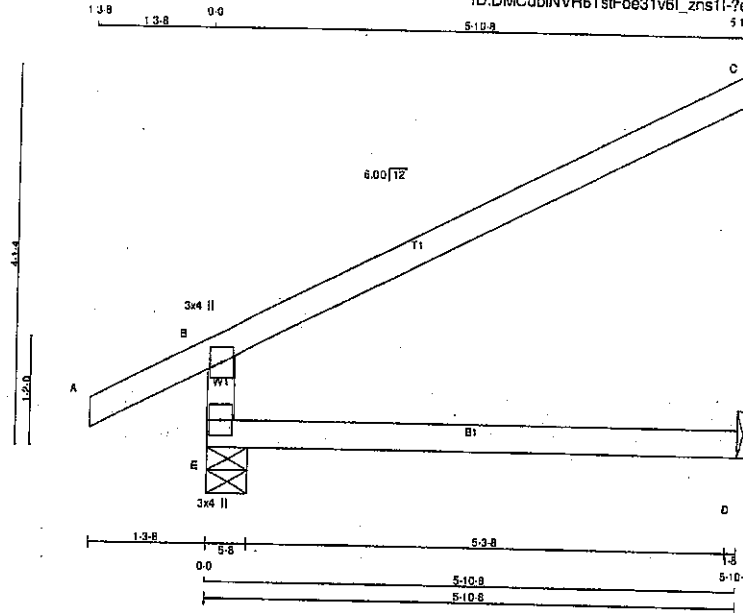

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	M720	3.0	4.0		
E	BMV1+p	M720	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
E	525	0	5-8	5-8
C	202	0	1-8	1-8
D	45	0	0	1-8

SEE MITEK STANDARD DETAIL B87791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
E	COMBINED	SNOW	LIVE	PERM. LIVE	
E	369	257/0	0/0	0/0	111/0
C	139	113/0	0/0	0/0	26/0
D	36	0/0	0/0	0/0	36/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	LCI	MAX	CS (LC)	UNBRAC LENGTH	FR-TO	WEBS	MAX. FACTORED FORCE (LBS)	MAX CS (LC)
E-B	-481/0	0.0	0.0	0.13 (4)	7.81					
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00					
B-C	-30/0	-91.8	-91.8	0.54 (1)	8.25					
E-D	0/0	-18.5	-18.5	0.13 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL = 6.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD = 39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CS: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MAX	MIN	MAX	MIN
MT20	618	354	1967 798 1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.19 (E) (INPUT = 0.90)
JSI METAL= 0.13 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007126

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	J20S	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version B.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:21 2020 Page 1					

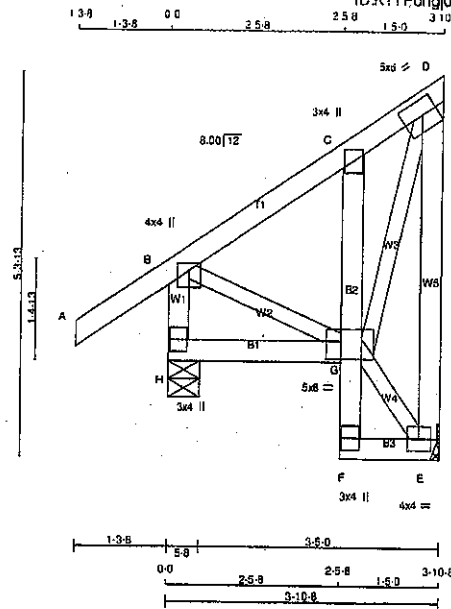

Scale = 1/2" = 1'-0"

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
H - B	2x4	DRY	No.2	SPF	
A - D	2x4	DRY	No.2	SPF	
H - G	2x4	DRY	No.2	SPF	
F - C	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.25	2.00
C TMV+p	MT20	3.0	4.0		
D TMVW+1	MT20	5.0	8.0	2.50	2.50
E BMVW+1	MT20	4.0	4.0		
F BMV+p	MT20	3.0	4.0		
G BMVW+1	MT20	5.0	8.0	3.00	2.50
H BMV+1	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORIZ	UPLIFT
H	332	0	0	5-8
E	206	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	232	168 / 0	0 / 0	0 / 0	0 / 0	66 / 0	0 / 0
E	145	95 / 0	0 / 0	0 / 0	0 / 0	50 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MEMB.	MAX. FACTORED	FORCE	VERT. LOAD	LC1	MAX.	MAX.	MEMB.	MAX. FACTORED	FORCE	MAX.
			(LBS)			(PLF)	CS1 (LC)			(LBS)	CS1 (LC)
FR-TO								FR-TO			
H-B	-307 / 0	0.0	0.0	0.03 (1)	7.81	B-G	0 / 83				
A-B	0 / 35	-91.8	-91.8	0.14 (5)	10.00	E-D	-184 / 0				
B-C	-83 / 0	-91.8	-91.8	0.07 (1)	6.25	G-E	-14 / 0				
C-D	-100 / 0	-91.8	-91.8	0.08 (1)	6.25	G-D	0 / 220				
H-G	0 / 0	-18.5	-18.5	0.04 (4)	10.00						
F-G	0 / 12	0.0	0.0	0.02 (1)	10.00						
G-C	-218 / 0	0.0	0.0	0.02 (1)	7.81						
F-E	0 / 9	-18.5	-18.5	0.01 (4)	10.00						

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 29 = 86 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (A-B-S), BC=0.04/1.00 (G-H-4), WB=0.05/1.00 (D-E-1), SS=0.09/1.00 (A-B-S)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.90)
JSI METAL = 0.07 (C) (INPUT = 1.00)

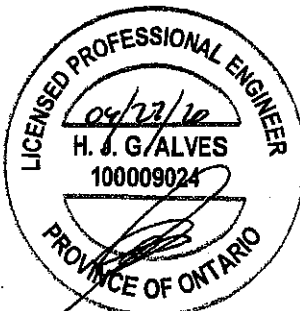


Structural component only
DWG# T-2007143

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	J40	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:14 2020 Page 1
ID:K?TPdngi0npl1qYdbWfOFzIdeG-9GFyHsAniRCiMWicinqYYGUjuVsSPHGLQM61Q2zNB1d

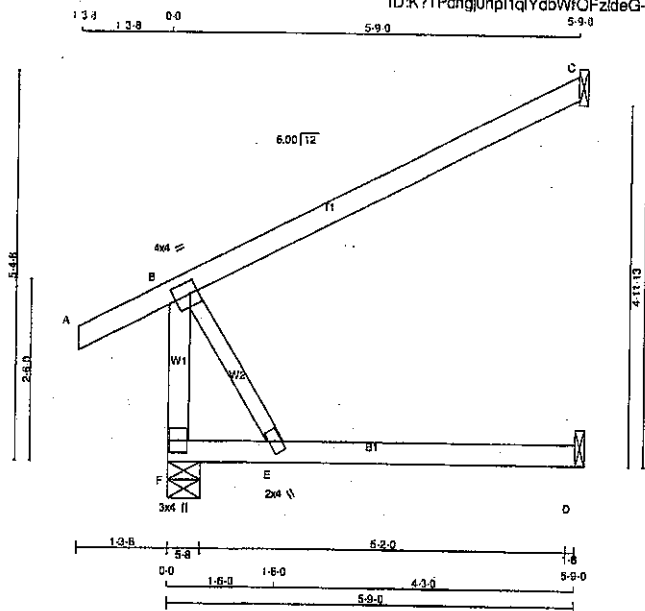

Scale = 1:20.2

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	4.0	2.00	1.25
E	BMV-w	MT20	2.0	4.0		
F	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	441	0	441	0
C	284	0	284	0
D	53	0	53	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LOASE	MAX./MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED						
F	310	217 / 0	0 / 0	0 / 0	0 / 0	99 / 0	0 / 0
C	182	147 / 0	0 / 0	0 / 0	0 / 0	35 / 0	0 / 0
D	49	0 / 0	0 / 0	0 / 0	0 / 0	43 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD LC1	MEMB.	FORCE
	(LBS)	(PLF)		(LBS)
FR-TO		FROM TO	FR-TO	
F-B	-388 / 0	0.0	0.0	0.05 (1)
A-B	0 / 28	-91.8	-91.8	0.12 (1)
B-C	0 / 0	-91.8	-91.8	0.52 (1)
F-E	0 / 0	-18.5	-18.5	0.14 (4)
E-D	0 / 0	-18.5	-18.5	0.18 (4)

TOTAL WEIGHT = 20 lb [M]

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.05")

CSI: TC=0.52/1.00 (B-C:1), BC=0.18/1.00 (D-E:4), WB=0.09/1.00 (S-E:1), SSI=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 (S BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10)

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788 1987 1856

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.24 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)

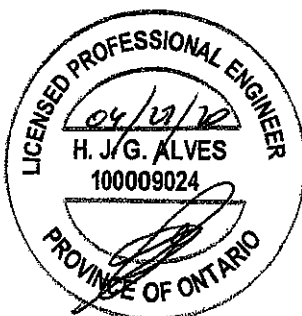

Structural component only
DWG# T-2007167

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	C40	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:08 2020 Page 1
ID:K7TPdhgJ0npl1qYdbWIOFzidsG-K7h1p606b5jebITMQj8I?Emz4pp?ZnT2QjCoZNB1

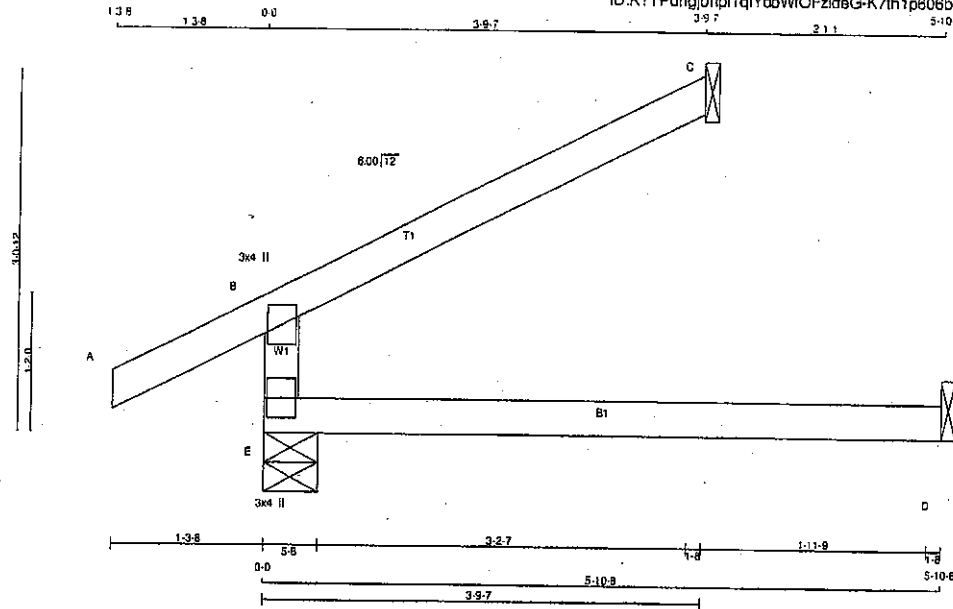

Scale = 1:17.9

TOTAL WEIGHT = 3 X 14 = 42 lb

LUMBER

N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
E	405	0	405	0	5-8	5-8
C	130	0	130	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	266	190 / 0	0 / 0	0 / 0	0 / 0	96 / 0	0 / 0
C	90	73 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	38	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED			MAX. UNBRACED LENGTH	MEMB. FR-TO	MAX. FACTORED		
		VERT. LOAD (PLF)	LC1	MAX CSI (LC)			FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO							
E-B	-342 / 0	0.0	0.0	0.13 (4)	7.81				
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00				
B-C	-19 / 0	-91.8	-91.8	0.22 (1)	6.25				
E-D	0 / 0	-18.5	-18.5	0.13 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CSI: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1867 788

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007162

JOB NAME 408170	TRUSS NAME C41	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 8 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:09 2020 Page 1
ID:K?TPdhgJ0npl1qYdbWfOFzIdeG-pJR3E96evaaGllw7ENrDmzIU9yK01cG4PGkrzNB1j

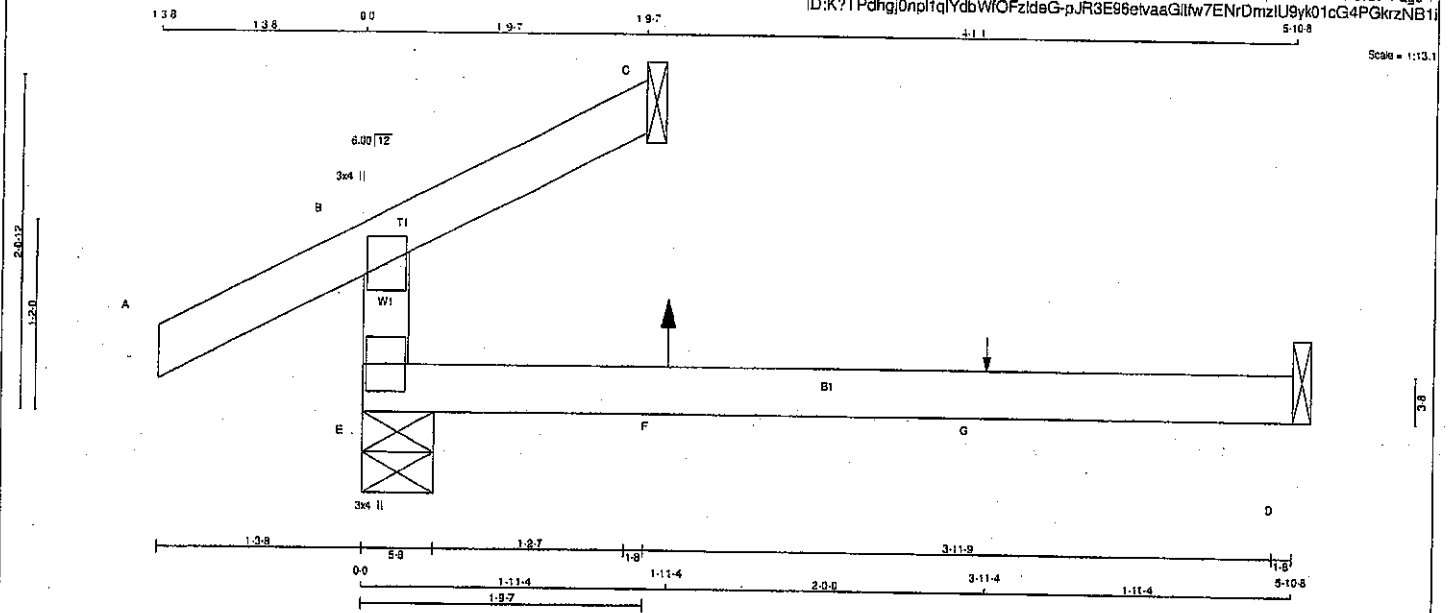

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
E BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
E	284	0	284	0	5-8	5-8
C	63	0	63	0	1-8	1-8
D	44	0	52	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN COMPONENT REACTIONS				DEAD	SOIL
		SNOW	LIVE	PERM.LIVE	WIND		
E	200	137 / 0	0 / 0	0 / 0	0 / 0	62 / 0	0 / 0
C	46	21 / 0	0 / 0	0 / 0	0 / 0	25 / 0	0 / 0
D	35	0 / 3	0 / 0	0 / 0	0 / 0	37 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (7)

MEMB.	CHORDS		WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX	MAX. FACTORED FORCE (LBS)	CS1 (LC)
FR-TO		FROM	TO	LENGTH	FR-TO	
E-B	-227 / 0	0.0	0.0	0.11 (4)	7.81	
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	
B-C	-9 / 9	-91.8	-91.8	0.08 (4)	10.00	
E-F	0 / 0	-18.5	-18.5	0.14 (4)	10.00	
F-G	0 / 0	-18.5	-18.5	0.14 (4)	10.00	
G-D	0 / 0	-18.5	-18.5	0.14 (4)	10.00	

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11-4	7	1	12	BACK	VERT	TOTAL	---	C1
G	3-11-4	1	1	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 3 X 12 = 35 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	818	354	1687	788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007163

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	C42	3	1	GREEN PARK HOMES	

Tamarack Root Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:10 2020 Page 1
ID:K?TFdhgj0npl1qYdbWIOFzIdeG-HV?SRV7GeCiRuvRr7ricNQJ6SuW4TTHmVkb8pHHZNB1h

Scale = 1:18.2

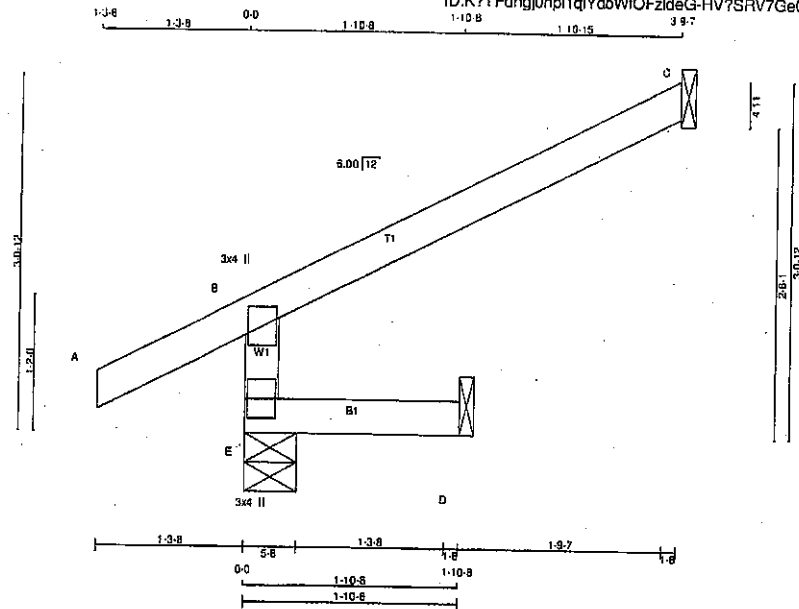

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table to inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
E	361	361	0	0
C	130	130	0	0
D	16	17	0	0

SEE MITEK STANDARD DETAIL 997791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
E	250	190 / 0	0 / 0	0 / 0	0 / 0	80 / 0	0 / 0
C	90	73 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	12	0 / 0	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED HORIZ. LOAD (LC1)	MAX. FACTORED UNBRACED LENGTH (FR-TO)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LC1)
E-B	-342 / 0	0.0	0.0	0.01 (4)	7.81	E-B	-342 / 0	0.0
A-B	0 / 26	-91.8	-91.8	0.13 (5)	10.00	A-B	0 / 26	-91.8
B-C	-19 / 0	-91.8	-91.8	0.22 (1)	6.25	B-C	-19 / 0	-91.8
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00	E-D	0 / 0	-18.5

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 10 = 29 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (N/A:0), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667	788	1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.14 (E) (INPUT = 0.90)
JSI METAL= 0.99 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007164

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	C43	3	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:11 2020 Page 1
ID:K?TPdhg0np1q1YdbWfOFzIdeG-#Zqfr8uPWqIV2011YHrwesJqls_CwXvK0uNpizNB1g

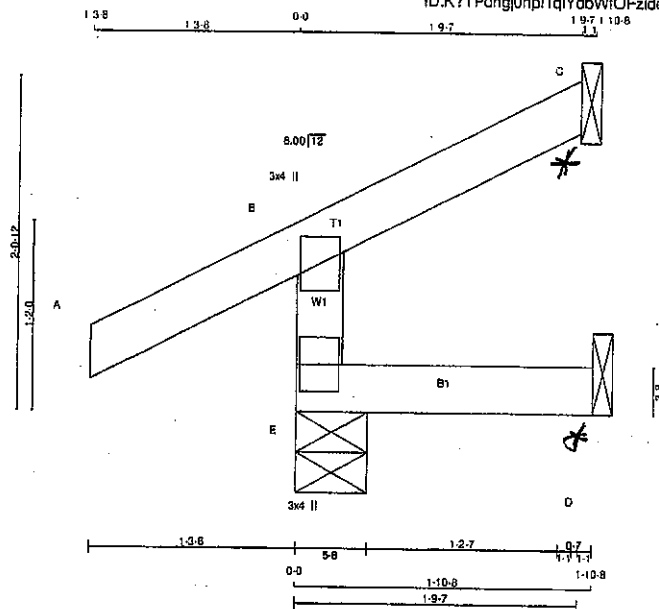

Scale = 1/12.1

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF		
A - C	2x4	DRY	No.2	SPF		
E - D	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REORD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
	VERT	HORZ	UPLIFT	IN-SX
E	271	0	271	0
C	45	0	45	0
D	8	0	17	0

SEE MITEK STANDARD DETAIL 697791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
E	188	141 / 0	0 / 0	0 / 0	0 / 0	47 / 0
C	31	24 / -18	0 / 0	0 / 0	0 / 0	7 / 0
D	7	0 / -8	0 / 0	0 / 0	0 / 0	12 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. CSF (LC)	MEMB. FORCE (LBS)
FR-TO		FROM TO	LENGTH FR-TO	
E-B	-244 / 0	0.0	0.04 (5)	7.81
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00
B-C	-17 / 0	-91.8	-91.8 0.09 (1)	6.25
E-D	0 / 0	-18.5	-18.5 0.04 (5)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 7 = 21 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6 PSF
	DL	= 6.0 PSF
BOT CH.	LL	= 0.0 PSF
	DL	= 7.4 PSF
TOTAL LOAD		= 39.0 PSF

SPACING = 24.0 IN. C.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TFC 2011, TFC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5),
WB=0.00/1.00 (n/a:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007165

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of a) easier installation, b) higher capacities, c) lower installed cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.


Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options Information on p. 126.

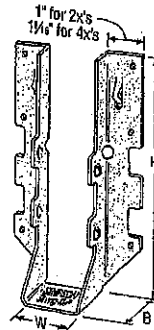


LUS28




LU26L



HUS210
(HUS26, HUS28,
and HHUS similar)



HGUS28-2




HHUS210-2



Double-Shear
Nailing
Top View





Double-Shear
Nailing
Side View;
Do not
bend tab



Dome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,560

Typical HUS28
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

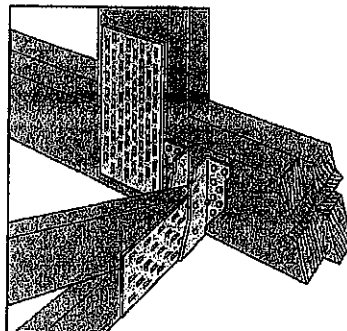

LJS26DS

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

HHUS/HGUS

See Hanger Options information on pp. 125–127.


HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.86 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
$W < 2"$	Bevel or square cut	0.62 of table value	0.46 of table value
$2" < W < 6"$	Bevel cut	0.67 of table value	0.41 of table value
$2" < W < 6"$	Square cut	0.46 of table value	0.41 of table value
$W > 6"$	Bevel cut	0.75 of table value	0.41 of table value

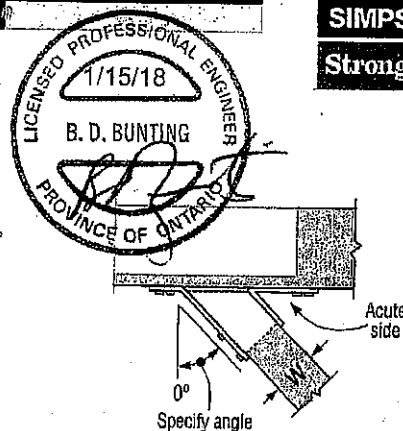

Top View HHUS Hanger
Skewed Right
(joist must be bevel cut)
All joist nails installed on the
outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance				
		W	H	B	d _g ³	Header	Joist	D.Fir-L		S-P-F		
								Uplift	Normal	Uplift	Normal	
								(K _D = 1.15) lb.	(K _D = 1.00) lb.	(K _D = 1.15) lb.	(K _D = 1.00) lb.	
Single 2x Sizes												
■	LUS24	18	1 7/16	3 1/4	1 1/4	2 1/4	(4) 10d	(2) 10d	710	1625	645	1155
									3.16	7.23	2.87	5.14
■	LU24L	22	1 7/16	3	1 1/4	2 1/4	(4) 10d	(2) 10d x 1 1/2"	360	1020	320	725
									1.80	4.54	1.42	3.22
■	LU26L	22	1 7/16	5	1 1/4	4 3/4	(6) 10d	(4) 10d x 1 1/2"	720	1605	645	1140
									3.20	7.14	2.87	5.07
SS	LUS26	18	1 7/16	4 3/4	1 1/4	3 3/4	(4) 10d	(4) 10d	1420	2170	1290	1830
									6.32	9.65	5.74	7.25
■	HUS26	16	1 1/8	5 3/4	3	3 15/16	(14) 16d	(6) 16d	2705	4940	2085	3875
									11.30	21.97	9.20	17.24
■	LJS26DS	18	1 7/16	5	3 1/2	4 3/4	(16) 16d	(6) 16d	2055	4265	1460	4115
									9.14	18.97	6.49	18.31
■	HGUS26	12	1 1/8	5 3/4	5	4 1/4	(20) 16d	(8) 16d	2685	6625	2685	5700
									11.96	29.51	11.96	25.35
■	LU28L	20	1 7/16	6 3/4	1 1/4	5 7/8	(8) 10d	(6) 10d x 1 1/2"	1140	2185	1020	1550
									5.07	9.72	4.54	6.89
SS	LUS28	18	1 7/16	6 3/4	1 1/4	3 3/4	(6) 10d	(4) 10d	1420	2520	1290	1790
									6.32	11.21	5.74	7.96
■	HUS28	16	1 1/8	7 1/8	3	6 1/16	(22) 16d	(8) 16d	3605	5365	2675	4345
									16.04	23.86	11.90	19.33
■	HGUS28	12	1 1/8	7 1/8	5	6 1/4	(36) 16d	(12) 16d	3310	7675	3310	6900
									14.74	34.19	14.74	30.73
■	LU210L	20	1 7/16	8	1 1/4	7 3/4	(10) 10d	(6) 10d x 1 1/2"	1140	2495	1020	1770
									5.07	11.10	4.54	7.87
SS	LUS210	18	1 7/16	7 1/16	1 1/4	3 1/4	(8) 10d	(4) 10d	1420	2785	1290	2210
									6.32	12.39	5.74	9.83

1. Factored uplift resistances have been increased 16% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSON and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/4" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

SIMPSON
Strong-Tie®

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _e ¹	Header	Joist	D, Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb.	(K _D = 1.00) lb.	(K _D = 1.15) lb.	(K _D = 1.00) lb.
								kN	kN	kN	kN
Double 2x Sizes											
LUS24-2	18	3 3/8	3 3/8	2	1 1/2	(4) 16d	(2) 16d	835 3.71	2020 8.99	590 2.62	1435 6.38
LUS26-2	18	3 3/8	4 3/8	2	4	(4) 16d	(4) 16d	1720 7.65	2595 11.54	1545 6.87	1920 8.54
HHUS26-2	14	3 3/8	5 3/8	3	3 1/8	(14) 16d	(6) 16d	2850 12.68	7335 32.63	2065 9.20	5205 23.15
HGUS26-2	12	3 3/8	5 3/8	4	4 1/8	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
LUS28-2	18	3 3/8	7	2	4	(6) 16d	(4) 16d	1720 7.65	3325 14.79	1545 6.87	2575 11.45
HHUS28-2	14	3 3/8	7 3/8	3	6 1/8	(22) 16d	(8) 16d	3765 16.75	8940 39.77	2675 11.90	6345 28.22
HGUS28-2	12	3 3/8	7 3/8	4	6 1/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
LUS210-2	18	3 3/8	9	2	6	(8) 16d	(6) 16d	2580 11.48	4500 20.02	2320 10.32	3195 14.21
HHUS210-2	14	3 3/8	9 3/8	3	8	(30) 16d	(10) 16d	4670 20.77	9660 42.97	4235 18.84	7000 31.14
HGUS210-2	12	3 3/8	9 3/8	4	8 1/8	(46) 16d	(16) 16d	6840 30.43	14015 62.34	4855 21.60	10270 45.69
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
HGUS28-3	12	4 1/8	7 1/8	4	6 3/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	4670 20.77	9670 43.02	4235 18.84	6965 30.54
HGUS210-3	12	4 1/8	9 1/8	4	8 3/8	(46) 16d	(16) 16d	6840 30.43	14645 65.14	4855 21.60	10400 46.26
Quadruple 2x Sizes											
HGUS26-4	12	6 3/8	5 3/8	4	4 1/8	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
HGUS28-4	12	6 3/8	7 3/8	4	6 1/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
HHUS210-4	14	6 3/8	8 3/8	3	7 3/8	(30) 16d	(10) 16d	4670 20.77	10155 45.17	4235 18.84	7210 32.07
HGUS210-4	12	6 3/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	6840 30.43	14645 65.14	4855 21.60	10400 46.26
HGUS212-4	12	6 3/8	10 3/8	4	10 1/8	(56) 16d	(20) 16d	7640 33.98	14995 66.70	5425 24.13	10645 47.35
HGUS214-4	12	6 3/8	12 3/8	4	11 1/8	(66) 16d	(22) 16d	10130 45.06	16400 72.95	7195 32.00	11645 51.80
4x Sizes											
LUS46	18	3 3/8	4 3/8	2	3 3/8	(4) 16d	(4) 16d	1720 7.65	2595 11.54	1545 6.87	1920 8.54
HHUS46	14	3 3/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	2840 11.30	7335 32.83	2065 9.20	5205 23.15
HGUS46	12	3 3/8	5 1/8	4	4 3/8	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
LUS48	18	3 3/8	6 3/8	2	3 3/8	(6) 16d	(4) 16d	1720 7.65	3325 14.79	1545 6.87	2575 11.45
HHUS48	14	3 3/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765 16.75	8940 39.77	2675 11.90	6345 28.22
HGUS48	12	3 3/8	7 1/8	4	6 3/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
LUS410	18	3 3/8	8 3/8	2	5 3/8	(8) 16d	(6) 16d	2580 11.48	4500 20.02	2320 10.32	3195 14.21
HGUS410	12	3 3/8	9	4	8 3/8	(46) 16d	(16) 16d	6840 30.43	14015 62.34	4855 21.60	10270 45.69
HGUS412	12	3 3/8	10 3/8	4	10 3/8	(56) 16d	(20) 16d	7640 33.98	14995 66.70	5425 24.13	10645 47.35
HGUS414	12	3 3/8	12 3/8	4	11 3/8	(66) 16d	(22) 16d	10130 45.06	16400 72.95	7195 32.00	11645 51.80

TC – Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

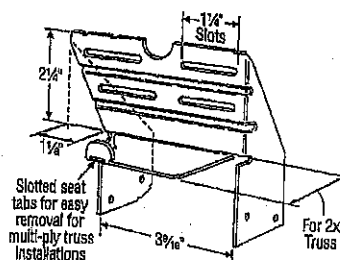


TC24
U.S. Patent 4,932,173

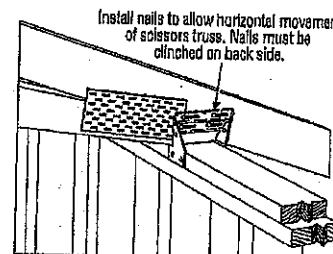


Typical TC24 Installation

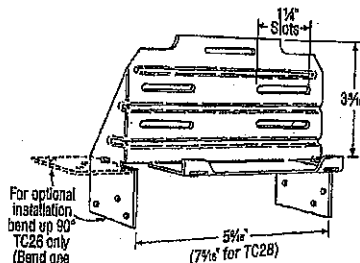

TC26
(TC28 Similar)

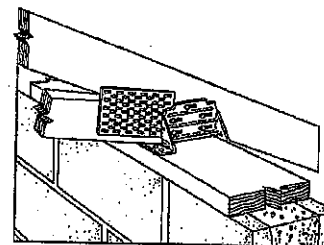

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer (8", 10", 12" Wall Installation Similar)

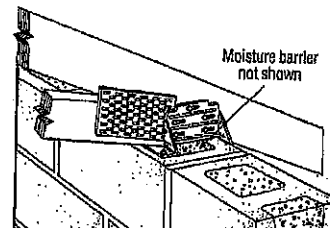

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _u =1.15) lb.	Uplift (K _u =1.15) lb.
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _u =1.15) lb.	Uplift (K _u =1.15) lb.
TC26	(5) 10d	(6) 10d x 1 1/2"	810	660
	(5) 10d	(6) 10d	930	680

1. Factored resistances have been increased 16% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.

2. Grout strength is 15 MPa minimum.

3. Optional TC26 installation with 10d nails requires minimum 5" top plate thickness.

4. TC26 fastened to grouted concrete block with (6) – 3/8" x 2 1/4" Titen screws has a factored uplift resistance of 275 lb.



UNITED STATES DESIGN

For more information, please contact your local Simpson Strong-Tie representative or visit us online at www.simpsonstrongtie.com. We are a leading manufacturer of metal fasteners and connectors for the construction industry. Our products are used in a wide variety of applications, including residential, commercial, and industrial construction. We are committed to providing high-quality products and excellent customer service.

(800) 999-5099
strongtie.com

H/TSP

SIMPSON
Strong-Tie

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p.24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_D = 1.15$)					
					D.Fir-L			S-P-F		
		To Rafters/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(6) 8d x 1½"	(4) 8d	—	740	685	300	680	495	215
					3.29	3.05	1.33	3.02	2.16	0.96
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
					3.58	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	265	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ²	18	(5) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.66	—	—
SS H10A ²	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	565	280
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^{2,3}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1465	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	1 (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
		2 (12) 8d x 1½"	(15) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
TSP	16	(9) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
					5.76	1.96	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.96	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H3 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.182" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

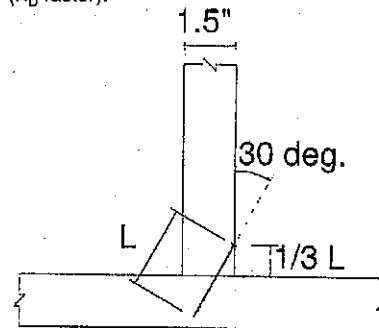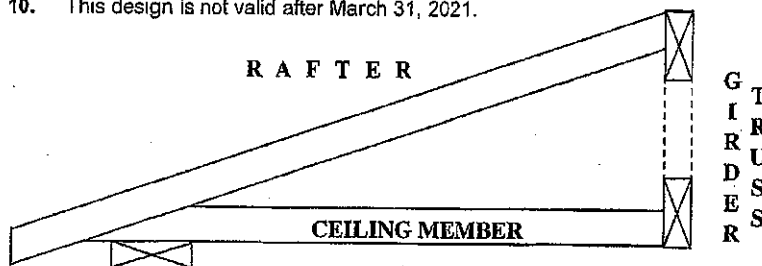


Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019

PEO
Certificate No. 10689485



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37679H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

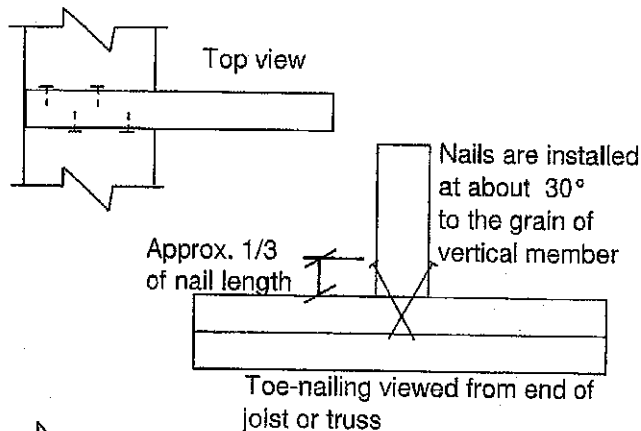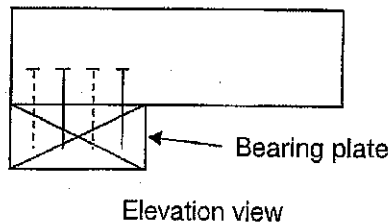

Toe-nailing on 2x4 Bearing Plate

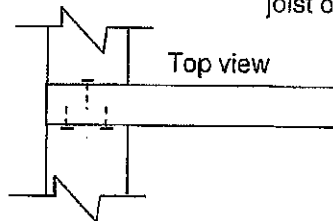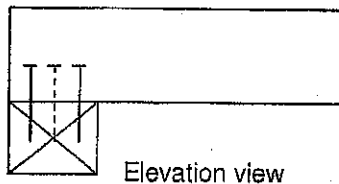

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7


December 2, 2019

PEO
Certificate No. 10889485.




Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/8" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in Mitek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

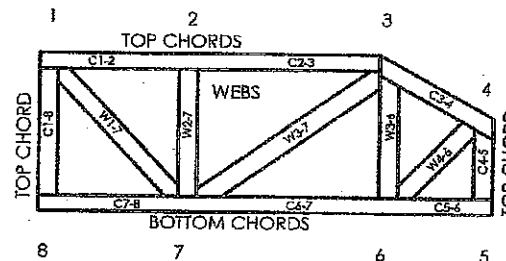

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 Mitek® All Rights Reserved

MiTek
POWER TO PERFORM.™

Mitek Engineering Reference Sheet: Mii-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSL.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected ovetop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

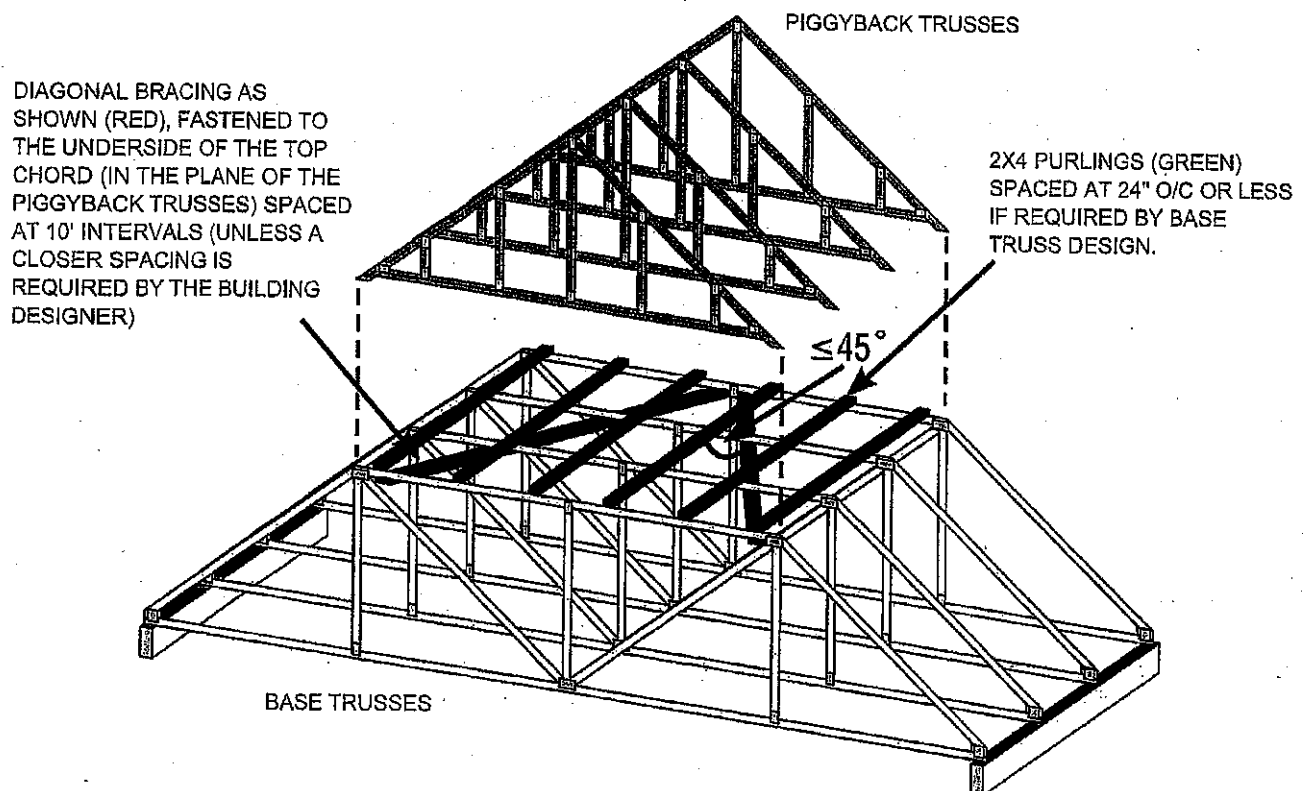


NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1900219

Feb 09, 2018