


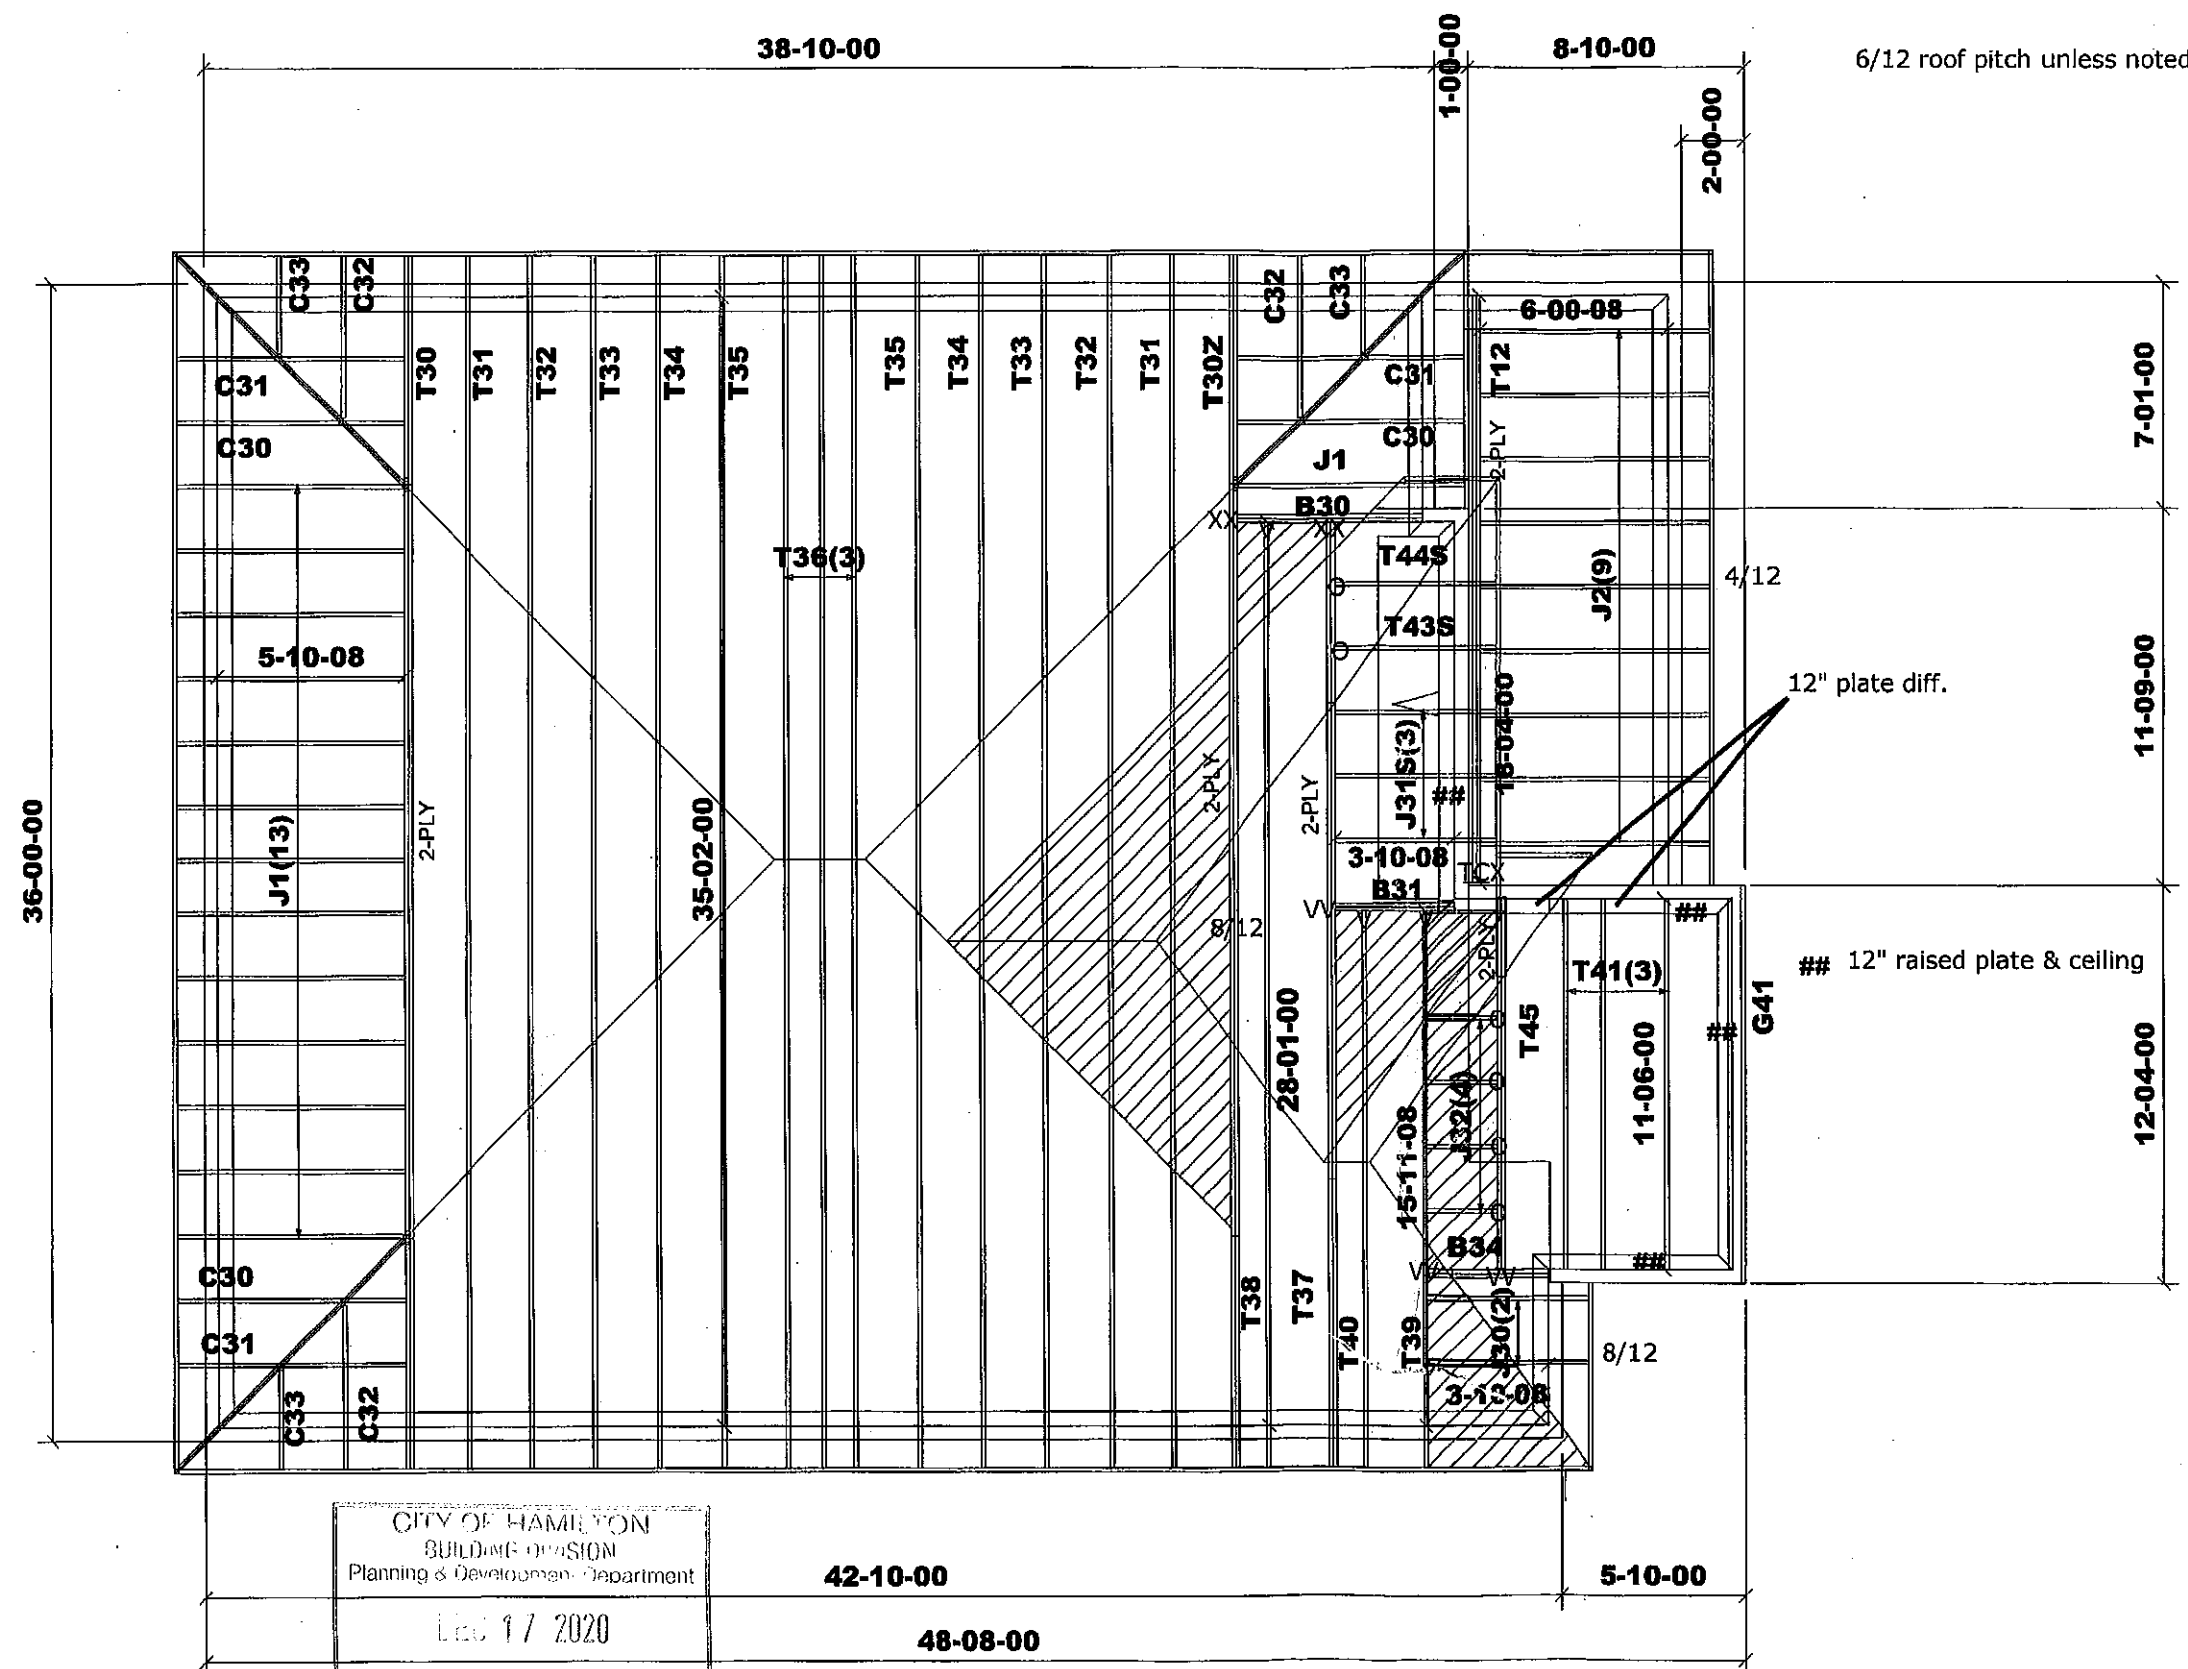

ASPHALT SHINGLES
 FINISHED OVERHANG: 12"
 2x6 EXTERIOR WALLS
 2x6 FASCIA BOARD
 HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment)
 Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY:
 RESIDENTIAL | PART: 9
 Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
 TCSL = 25.6 psf
 TCDL = 6.0 psf
 BCLL = 0.0 psf
 BCDL = 7.4 psf

HARDWARE:
 LUS24 - (O)
 LJS26DS - (V)
 HGUS26-2 - (XX)
 LUS26-2(VV)

BEAMS:
 B30=B31 = B34=
 2 - 2x10 SPF #2

 **DENOTES:**
CONVENTIONAL
FRAMING

CITY OF HAMILTON
 BUILDING DIVISION
 Planning & Development Department
 DEC 17 2020
 REC'D BY _____ DATE _____
 REF'D TO _____ DATE _____



Job Track: **51225**
 Plan Log: **202376**
 Layout ID: **408089**

Builder / Location: **GREEN PARK HOMES / WATERDOWN**
 Project: **RUSSELL GARDENS PH.3**
 Date: 2020-04-27 Sales: Mario DiCano Designer: JG

Model / Elevation: **MOUNTAINASH 2/3 STD OR OPT.5 BR** *LOT 100*
 THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

Mitek ver 8.3.1.215

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 2
 Lot #: 100
 Elevation: 3 STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202376
 Layout ID: 408089
 Ref #: 1 of 3
 Page: 1 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T12 Flat Girder	0 / 12	18-04-00	2-04-02	2 x 6 2 x 4		2-04-02 2-04-02	154.37 94.00		
	1 2-ply	T30 Hip Girder	6 / 12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	317.54 198.67		
	1 2-ply	T30Z Hip Girder	6 / 12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	317.54 198.67		
	2	T31 Hip	6 / 12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.99 174.00		
	2	T32 Hip	6 / 12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.1 174.67		
	2	T33 Hip	6 / 12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	289.07 179.67		
	2	T34 Hip	6 / 12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	290.73 183.33		
	2	T35 Hip	6 / 12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	309.55 198.00		
	3	T36 Common	6 / 12	35-02-00	9-11-08	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	455.04 279.00		
	1 2-ply	T37 Hip Girder	6 / 12	28-01-00	4-11-13	2 x 4 2 x 6	1-03-08	1-02-00 2-02-00	251.08 159.67		
	1	T38 Hip	6 / 12	28-01-00	6-03-13	2 x 4	1-03-08	1-02-00 2-02-00	118.65 75.50		
	1	T39 Hip Girder	6 / 12	15-11-08	3-11-13	2 x 4 2 x 6	1-03-08	1-02-00 1-04-04	70.36 44.67		
	1	T40 Common	6 / 12	15-11-08	5-03-00	2 x 4	1-03-08	1-02-00 1-04-04	61.19 37.83		
	3	T41 Flat	0 / 12	11-06-00	4-00-00	2 x 4		4-00-00 4-00-00	141.44 91.00		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 2
 Lot #: 100
 Elevation: 3 STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202376
 Layout ID: 408089
 Ref #
 Page: 2 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T43S Half Hip	8 /12	3-10-08	4-01-04	2 x 4	1-03-08	1-04-13 4-01-04	28.35 18.33		
	1	T44S Half Hip	8 /12	3-10-08	3-01-04	2 x 4	1-03-08	1-04-13 3-01-04	23.91 17.60		
	1 2-ply	T46 Flat Girder	0 /12	11-06-00	2-04-02	2 x 4		2-04-02 2-04-02	85.38 53.33		
	14	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	235.1 149.33		
	9	J2 Jack-Open	4 /12	6-00-08	2-09-00	2 x 4	1-03-08	3-15 2-04-02	142.33 90.00		
	2	J30 Jack-Open	8 /12	3-10-08	3-11-13	2 x 4	1-03-08	1-04-13 3-11-13	28.34 18.00		
	3	J31S Jack-Open	8 /12	3-10-08	4-11-13	2 x 4	1-03-08	1-04-13 4-11-13	82.8 57.50		
	4	J32 Jack-Open	8 /12	2-02-08	3-11-13	2 x 4		2-06-02 3-11-13	40.96 30.00		
	3	C30 Jack-Open	6 /12	3-09-08	3-00-12	2 x 4	1-03-08 2-01-00	1-02-00 3-00-12	42.4 26.00		
	3	C31 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	34.75 22.00		
	3	C32 Jack-Open	6 /12	1-10-08	3-00-11	2 x 4	1-03-08 1-10-14	1-02-00 2-01-04	28.7 18.00		
	3	C33 Jack-Open	6 /12	1-09-06	2-00-11	2 x 4	1-03-08 1-02	1-02-00 2-00-11	21.05 14.00		
	1	G41 GABLE	0 /12	11-06-00	4-00-00	2 x 4		4-00-00 4-00-00	47.93 31.33		

TOTAL # TRUSS= 76

TOTAL BFT OF ALL TRUSSES= 2632

BFT.

TOTAL WEIGHT OF ALL TRSSES 4171.63 LBS

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
Builder: GREEN PARK HOMES
Project: RUSSELL GARDENS PH.3
Location: WATERDOWN
Model: MOUNTAINASH 2
Lot #: 100
Elevation: 3 STD OR OPT.5 BR


Job Track: 51225
PlanLog: 202376
Layout ID: 408089
Ref #
Page: 3 of 3
Date: 04-27-2020
Designer:
Sales Rep: Mario DiCano

HARDWARE

QTY	TYPE	MODEL	LENGTH
2	Hardware	HGUS26-2	
3	Hardware	LJS26DS	
6	Hardware	LUS24	
3	Hardware	LUS26-2	

TOTAL NUMBER OF
ITEMS=

14

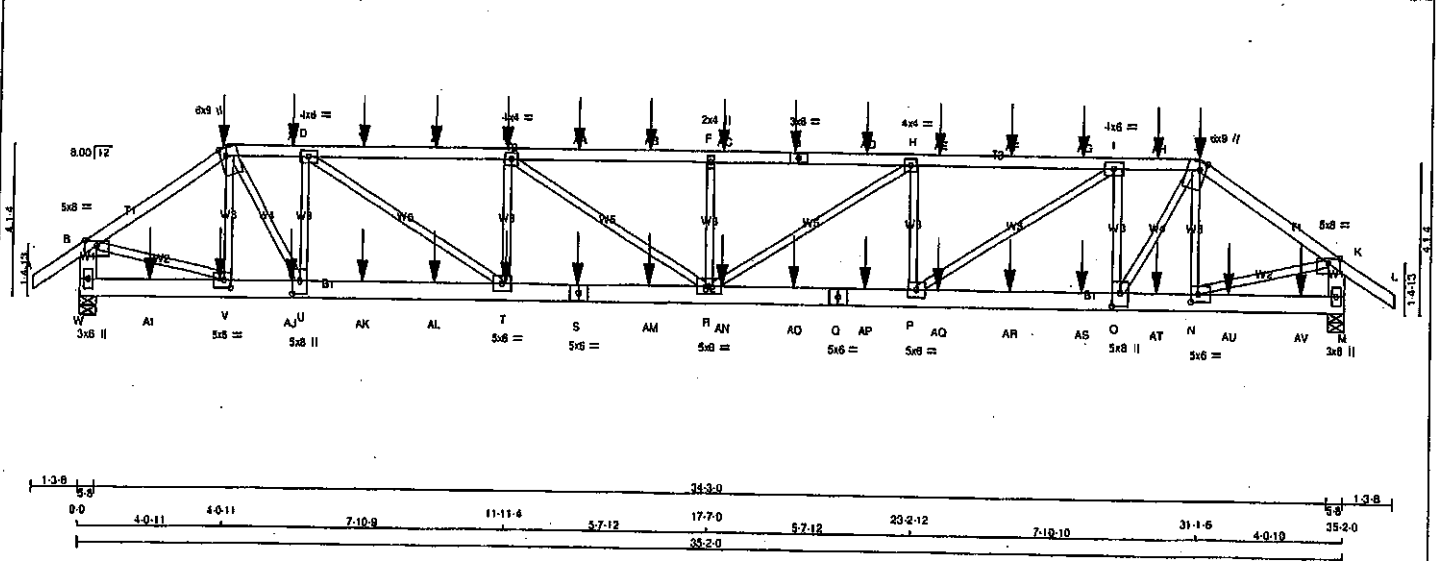

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - G	2x4	DRY	No.2	SPF
G - J	2x4	DRY	No.2	SPF
J - L	2x4	DRY	No.2	SPF
W - B	2x6	DRY	No.2	SPF
M - K	2x6	DRY	No.2	SPF
W - S	2x6	DRY	No.2	SPF
S - Q	2x6	DRY	No.2	SPF
Q - M	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.
DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE(81.0)
C - G	12	SIDE(81.0)
G - J	12	SIDE(81.0)
J - L	12	SIDE(81.0)
W - B	2	TOP
M - K	2	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
W - S	2	SIDE(83.1)
S - Q	2	SIDE(81.0)
Q - M	2	SIDE(81.0)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
W	3393 0	3393 0	5-8	5-8
M	3342 0	3342 0	5-8	5-8

UNFACTORED REACTIONS	1ST LOASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
W	2397 1588 / 0	0 / 0 0 / 0 812 / 0 0 / 0
M	2363 1555 / 0	0 / 0 0 / 0 808 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) W, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.04 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LG1 MAX (PLF)	UNBRAC LENGTH FR-TO	MEMB. FORCE (LBS)
FR-TO				
A-B	0 / 35	-91.8 -91.8 0.07 (1)	10.00	V-C -703 / 0 0.09 (1)
B-C	-4010 / 0	-91.8 -91.8 0.22 (1)	4.55	C-U 0 / 2685 0.33 (1)
C-X	-4686 / 0	-91.8 -91.8 0.29 (1)	4.16	U-D -2159 / 0 0.27 (1)
X-D	-4686 / 0	-91.8 -91.8 0.29 (1)	4.16	D-I -2187 / 0 0.28 (1)
D-Y	-6989 / 0	-91.8 -91.8 0.81 (1)	3.27	O-J 0 / 2713 0.34 (1)
Y-Z	-6989 / 0	-91.8 -91.8 0.81 (1)	3.27	N-J -681 / 0 0.09 (1)
Z-E	-6989 / 0	-91.8 -91.8 0.81 (1)	3.27	B-V 0 / 3425 0.42 (1)
E-AA	-7711 / 0	-91.8 -91.8 0.81 (1)	3.07	N-K 0 / 3359 0.42 (1)
AA-AB	-7711 / 0	-91.8 -91.8 0.81 (1)	3.07	P-I 0 / 2778 0.34 (1)
AB-F	-7711 / 0	-91.8 -91.8 0.81 (1)	3.04	O-T 0 / 2747 0.34 (1)
F-AC	-7711 / 0	-91.8 -91.8 0.70 (1)	3.04	P-H -1354 / 0 0.17 (1)
AC-G	-7711 / 0	-91.8 -91.8 0.70 (1)	3.04	T-E -1337 / 0 0.17 (1)
G-AD	-7711 / 0	-91.8 -91.8 0.70 (1)	3.04	R-H 0 / 893 0.11 (1)
AD-H	-7711 / 0	-91.8 -91.8 0.70 (1)	3.04	E-R 0 / 895 0.11 (1)
H-AE	-6966 / 0	-91.8 -91.8 0.63 (1)	3.24	R-F -808 / 0 0.10 (1)
AE-AF	-6966 / 0	-91.8 -91.8 0.63 (1)	3.24	
AF-AG	-6966 / 0	-91.8 -91.8 0.63 (1)	3.24	
AG-I	-6966 / 0	-91.8 -91.8 0.63 (1)	3.24	
I-AH	-4647 / 0	-91.8 -91.8 0.30 (1)	4.16	
AH-J	-4647 / 0	-91.8 -91.8 0.30 (1)	4.16	
J-K	-3933 / 0	-91.8 -91.8 0.22 (1)	4.59	
K-L	0 / 35	-91.8 -91.8 0.07 (1)	10.00	
W-B	-3343 / 0	0.0 0.0 0.12 (1)	7.81	
M-K	-3285 / 0	0.0 0.0 0.12 (1)	7.86	

W-AI	0 / 0	-18.5 -18.5 0.04 (4)	10.00
AI-V	0 / 0	-18.5 -18.5 0.04 (4)	10.00
V-AJ	0 / 3311	-18.5 -18.5 0.22 (1)	10.00
AJ-U	0 / 3311	-18.5 -18.5 0.22 (1)	10.00
U-AK	0 / 4697	-18.5 -18.5 0.35 (1)	10.00
AK-AL	0 / 4697	-18.5 -18.5 0.35 (1)	10.00
AL-T	0 / 4697	-18.5 -18.5 0.35 (1)	10.00
T-S	0 / 6989	-18.5 -18.5 0.52 (1)	10.00
S-AM	0 / 6989	-18.5 -18.5 0.52 (1)	10.00
AM-R	0 / 6989	-18.5 -18.5 0.52 (1)	10.00
R-AN	0 / 6986	-18.5 -18.5 0.52 (1)	10.00
AN-AO	0 / 6986	-18.5 -18.5 0.52 (1)	10.00
AO-Q	0 / 6966	-18.5 -18.5 0.52 (1)	10.00
Q-AP	0 / 6966	-18.5 -18.5 0.52 (1)	10.00
AP-P	0 / 8966	-18.5 -18.5 0.52 (1)	10.00
P-AQ	0 / 1648	-18.5 -18.5 0.35 (1)	10.00
AQ-AR	0 / 1648	-18.5 -18.5 0.35 (1)	10.00
AR-AS	0 / 1648	-18.5 -18.5 0.35 (1)	10.00

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIAL LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD)
EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = U/999 (0.24")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = U/982 (0.44")

CSI: TC=0.70/1.00 (F-H:1), BC=0.52/1.00 (P-R:1),
WB=0.42/1.00 (B-V:1), SS=0.19/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (I) INPUT = 0.90 ;
JSI METAL = 0.67 (I) INPUT = 1.00 ;



Structural component only
DWG# T-2006952

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW+m	MT20	6.0	9.0	Edge	2.00
D	TMVW-l	MT20	4.0	6.0		
E	TMVW-l	MT20	4.0	4.0		
F	TMVW-w	MT20	2.0	4.0		
G	TS-l	MT20	3.0	6.0		
H	TMVW-l	MT20	4.0	4.0		
I	TMVW-l	MT20	4.0	6.0		
J	TTWW+m	MT20	6.0	9.0	Edge	2.00
K	TMVW-p	MT20	5.0	8.0	Edge	
M	BMV1+p	MT20	3.0	6.0		
N	BMVW-l	MT20	5.0	8.0	2.50	2.25
O	BMVW-l	MT20	5.0	8.0	4.25	2.50
P	BMVW-l	MT20	5.0	6.0		
Q	BS-l	MT20	5.0	6.0		
R	BMVW-l	MT20	5.0	8.0		
S	BS-l	MT20	5.0	6.0		
T	BMVW-l	MT20	5.0	6.0		
U	BMVW-l	MT20	5.0	8.0	4.25	2.50
V	BMVW-l	MT20	5.0	6.0	2.50	2.25
W	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MAX. UNBRAC. LENGTH	MEMB. FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO					
AS-O	0.74648	-18.5	-18.5	0.35 (1)	10.00		
O-AT	0.73248	-18.5	-18.5	0.22 (1)	10.00		
AT-N	0.73248	-18.5	-18.5	0.22 (1)	10.00		
N-AU	0.0	-18.5	-18.5	0.03 (4)	10.00		
AU-AV	0.0	-18.5	-18.5	0.03 (4)	10.00		
AV-M	0.0	-18.5	-18.5	0.03 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)


JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-11	-49	-55		FRONT	VERT	DEAD		C1
C	4-0-11	-117	-117		BACK	VERT	TOTAL		C1
C	4-0-11	-254	-254		FRONT	VERT	SNOW		C1
E	11-11-4	-110	-110		BACK	VERT	TOTAL		C1
G	19-11-4	-110	-110		BACK	VERT	TOTAL		C1
J	31-1-8	-49	-55		FRONT	VERT	DEAD		C1
J	31-1-8	-254	-254		FRONT	VERT	SNOW		C1
S	13-11-4	-26	-26		BACK	VERT	TOTAL		C1
T	11-11-4	-26	-26		BACK	VERT	TOTAL		C1
V	3-11-4	-26	-26		BACK	VERT	TOTAL		C1
X	5-11-4	-110	-110		BACK	VERT	TOTAL		C1
Y	7-11-4	-110	-110		BACK	VERT	TOTAL		C1
Z	9-11-4	-110	-110		BACK	VERT	TOTAL		C1
AA	13-11-4	-110	-110		BACK	VERT	TOTAL		C1
AB	15-11-4	-110	-110		BACK	VERT	TOTAL		C1
AC	17-11-4	-110	-110		BACK	VERT	TOTAL		C1
AD	21-11-4	-110	-110		BACK	VERT	TOTAL		C1
AE	23-11-4	-110	-110		BACK	VERT	TOTAL		C1
AF	25-11-4	-110	-110		BACK	VERT	TOTAL		C1
AG	27-11-4	-110	-110		BACK	VERT	TOTAL		C1
AH	29-11-4	-110	-110		BACK	VERT	TOTAL		C1
AI	1-11-4	-26	-26		BACK	VERT	TOTAL		C1
AJ	5-11-4	-26	-26		BACK	VERT	TOTAL		C1
AK	7-11-4	-26	-26		BACK	VERT	TOTAL		C1
AL	9-11-4	-26	-26		BACK	VERT	TOTAL		C1
AM	15-11-4	-26	-26		BACK	VERT	TOTAL		C1
AN	17-11-4	-26	-26		BACK	VERT	TOTAL		C1
AO	19-11-4	-26	-26		BACK	VERT	TOTAL		C1
AP	21-11-4	-26	-26		BACK	VERT	TOTAL		C1
AQ	23-11-4	-26	-26		BACK	VERT	TOTAL		C1
AR	25-11-4	-26	-26		BACK	VERT	TOTAL		C1
AS	27-11-4	-26	-26		BACK	VERT	TOTAL		C1
AT	29-11-4	-26	-26		BACK	VERT	TOTAL		C1
AU	31-11-4	-26	-26		BACK	VERT	TOTAL		C1
AV	33-11-4	-26	-26		BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Tamarack Roof Truss, Burlington Version 8.310 S Oct 29 2018 Mitek Industries, Inc. Sat Apr 25 08:53:15 2020 Page 1
ID:DMCubINVR6TstFoe31v6l, zns11-3F3PwO3sQ2YcIC33JlaxFmCV7Eqi7SCeq0bRzNEh2

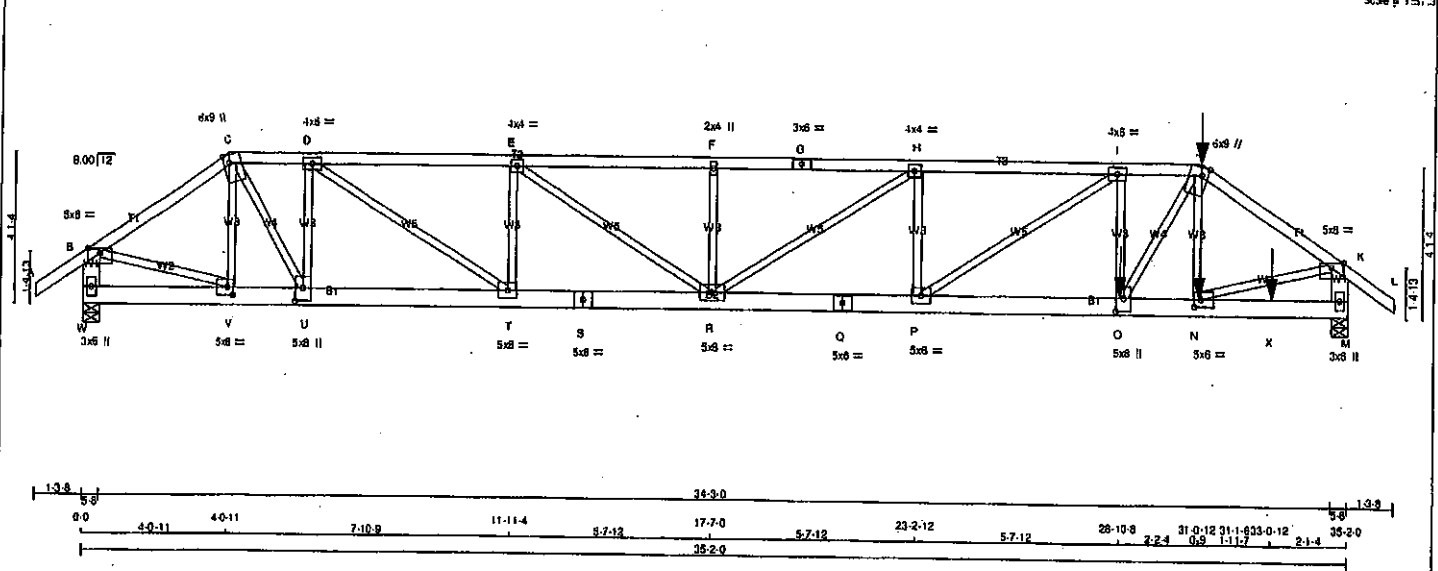

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - G	2x4	DRY	No.2	SPF
G - J	2x4	DRY	No.2	SPF
J - L	2x4	DRY	No.2	SPF
W - B	2x8	DRY	No.2	SPF
M - K	2x8	DRY	No.2	SPF
W - S	2x8	DRY	No.2	SPF
S - Q	2x8	DRY	No.2	SPF
Q - M	2x8	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF

EXCEPT
DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C	12	TOP
C-G	12	TOP
G-J	12	SIDE(61.0)
J-L	12	SIDE(61.0)
W-B	2	TOP
M-K	2	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
W-S	2	TOP
S-Q	2	TOP
Q-M	2	SIDE(163.1)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	1	SIDE(427.3)
I-O	1	
D-U	1	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT 2536	DOWN 2536	0	5-8
W	HORIZ 0	UPLIFT 0	5-8	5-8
M	VERT 4405	DOWN 4405	0	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERMLIVE WIND DEAD SOIL
W	1791 1188 / 0 0 / 0 0 / 0 603 / 0 0 / 0
M	3114 2053 / 0 0 / 0 0 / 0 1081 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) W, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.38 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	CS (LC)
FR-TO				FR-TO			
A-B	0 / 35	-91.8 -91.8 0.07 (1)	10.00	V-C	-516 / 0	0.07 (1)	
B-C	-2897 / 0	-91.8 -91.8 0.18 (1)	5.22	C-U	0 / 2211	0.27 (1)	
C-D	-3532 / 0	-91.8 -91.8 0.18 (1)	4.83	U-D	-1810 / 0	0.23 (1)	
D-E	-5663 / 0	-91.8 -91.8 0.39 (1)	3.83	C-I	-867 / 0	0.11 (1)	
E-F	-6822 / 0	-91.8 -91.8 0.47 (1)	3.48	C-J	0 / 3695	0.48 (1)	
F-G	-6822 / 0	-91.8 -91.8 0.48 (1)	3.45	N-J	-872 / 0	0.11 (1)	
G-H	-6822 / 0	-91.8 -91.8 0.48 (1)	3.45	B-V	0 / 2475	0.31 (1)	
H-I	-7098 / 0	-91.8 -91.8 0.50 (1)	3.38	N-K	0 / 4578	0.57 (1)	
I-J	-6332 / 0	-91.8 -91.8 0.25 (1)	3.70	P-I	0 / 916	0.11 (1)	
J-K	-5358 / 0	-91.8 -91.8 0.28 (1)	3.99	D-T	0 / 2553	0.32 (1)	
K-L	0 / 35	-91.8 -91.8 0.07 (1)	10.00	P-H	-383 / 0	0.08 (1)	
W-B	-2502 / 0	0.0 0.0 0.09 (1)	7.81	T-E	-1302 / 0	0.17 (1)	
M-K	-4381 / 0	0.0 0.0 0.16 (1)	6.67	P-H	-329 / 0	0.14 (1)	
				E-R	0 / 1389	0.17 (1)	
				R-F	-503 / 0	0.08 (1)	
W-V	0 / 0	-18.5 -18.5 0.02 (4)	10.00				
V-U	0 / 2392	-18.5 -18.5 0.16 (1)	10.00				
U-T	0 / 3533	-18.5 -18.5 0.26 (1)	10.00				
T-S	0 / 5663	-18.5 -18.5 0.42 (1)	10.00				
S-R	0 / 5663	-18.5 -18.5 0.42 (1)	10.00				
R-Q	0 / 7098	-18.5 -18.5 0.51 (1)	10.00				
Q-P	0 / 7098	-18.5 -18.5 0.51 (1)	10.00				
P-O	0 / 6332	-18.5 -18.5 0.48 (1)	10.00				
O-N	0 / 4426	-18.5 -18.5 0.35 (1)	10.00				
N-X	0 / 0	-18.5 -18.5 0.03 (4)	10.00				
X-M	0 / 0	-18.5 -18.5 0.03 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
J	31-1-6	-49	-55	---	FRONT	VERT	DEAD	---	C1
J	31-1-6	-118	-118	---	FRONT	VERT	TOTAL	---	C1
J	31-1-6	-254	-254	---	FRONT	VERT	SNOW	---	C1
N	31-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
O	28-10-8	-2340	-2340	---	FRONT	VERT	TOTAL	---	C1
X	33-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = U/999 (0.21)
ALLOWABLE DEFL.(TL) = L/360 (1.17)
CALCULATED VERT. DEFL.(TL) = U/999 (0.39)

CSI: TC=0.50/1.00 (H-I:1), BC=0.51/1.00 (P-R:1), WB=0.57/1.00 (K-N:1), SS=0.12/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (N) INPUT = 0.90
JSI METAL = 0.65 (S) INPUT = 1.00

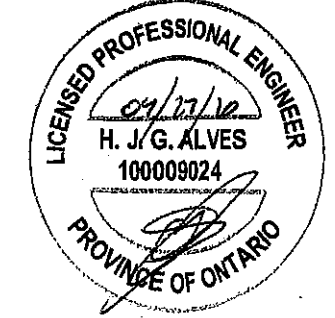

Structural component only
DWG# T-2006953 1/2


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408087	T1Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 08:53:15 2020 Page 2
ID:DMCubINVR6TstFes31v6I_zns1I-3P3PwiO3sQ2YciCS3JfaxFmCV7Egi7SCeq0bRzNEh2


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	5.0	8.0	Edge	
C	TTWW+m	MT20	6.0	9.0	Edge	2.00
D	TMWW-t	MT20	4.0	8.0		
E	TMWW-t	MT20	4.0	4.0		
F	TMWW-w	MT20	2.0	4.0		
G	TS-t	MT20	3.0	8.0		
H	TMWW-t	MT20	4.0	4.0		
I	TMWW-t	MT20	4.0	6.0		
J	TTWW+m	MT20	6.0	9.0	Edge	2.00
K	TMWW-p	MT20	5.0	8.0	Edge	
M	BMV1+p	MT20	3.0	6.0		
N	BMWW-t	MT20	5.0	6.0	2.50	2.00
O	BMWW-t	MT20	5.0	8.0	4.25	2.50
P	BMWW-t	MT20	5.0	6.0		
Q	BS-t	MT20	5.0	6.0		
R	BMWW-t	MT20	5.0	8.0		
S	BS-t	MT20	5.0	6.0		
T	BMWW-t	MT20	5.0	8.0		
U	BMWW-t	MT20	5.0	8.0	4.25	2.50
V	BMWW-t	MT20	5.0	6.0	2.50	2.00
W	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

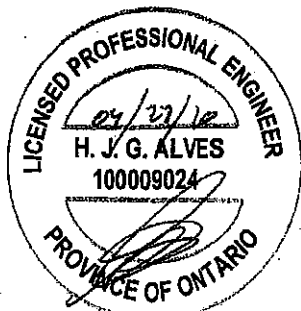

Structural component only
DWG# T-2006953 2/2

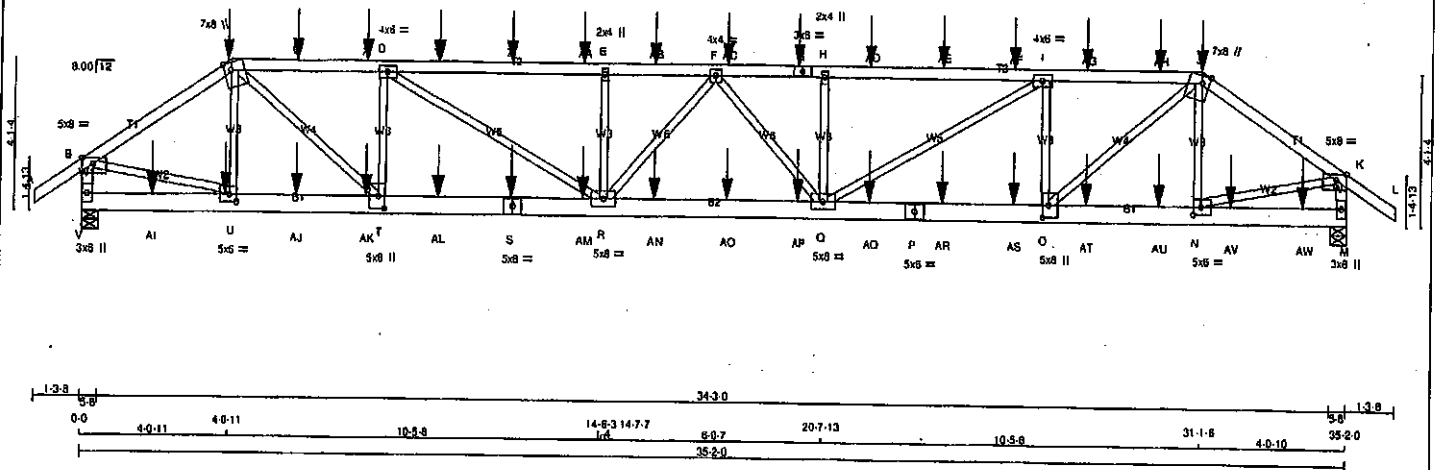

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
J - L	2x4	DRY	No.2
V - S	2x4	DRY	No.2
M - K	2x4	DRY	No.2
V - S	2x4	DRY	No.2
S - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2

EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (#)	LOAD (PLF)
TOP CHORDS: (0.122'X3') SPIRAL NAILS		
A - C	12	SIDE(61.0)
C - G	12	SIDE(61.0)
G - J	12	SIDE(61.0)
J - L	12	SIDE(61.0)
V - S	12	TOP
M - K	12	TOP
BOTTOM CHORDS: (0.122'X3') SPIRAL NAILS		
V - S	12	SIDE(183.1)
S - P	12	SIDE(0.0)
P - M	12	SIDE(0.0)
WEBS: (0.122'X3') SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3.0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	3393	0	5-8	5-8
M VERT	3342	0	5-8	5-8

UNFACTORED REACTIONS

	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	2387	1586 / 0
V LIVE	0	0 / 0
M LIVE	2383	1555 / 0
PERMALIVE	0	0 / 0
WIND	0	0 / 0
DEAD	812	0 / 0
SOIL	808	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.05 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	
FR-TO		FROM TO	CSI (LC)	FR-TO		CSI (LC)	
A-B	0 / 35	-91.8	-91.8 0.07 (1)	10.00	U-C	-658 / 0 0.08 (1)	
B-C	-4013 / 0	-91.8	-91.8 0.22 (1)	4.55	C-T	0 / 3210 0.40 (1)	
C-W	-5748 / 0	-91.8	-91.8 0.49 (1)	3.60	T-D	-1922 / 0 0.24 (1)	
W-X	-5748 / 0	-91.8	-91.8 0.49 (1)	3.60	O-I	-1945 / 0 0.25 (1)	
X-D	-5748 / 0	-91.8	-91.8 0.49 (1)	3.60	O-J	0 / 3243 0.40 (1)	
D-Y	-7499 / 0	-91.8	-91.8 0.78 (1)	3.07	N-J	-639 / 0 0.08 (1)	
Y-Z	-7499 / 0	-91.8	-91.8 0.78 (1)	3.07	B-U	0 / 3428 0.42 (1)	
Z-AA	-7499 / 0	-91.8	-91.8 0.78 (1)	3.07	N-K	0 / 3361 0.42 (1)	
AA-E	-7499 / 0	-91.8	-91.8 0.78 (1)	3.07	Q-I	0 / 2078 0.28 (1)	
E-AB	-7499 / 0	-91.8	-91.8 0.48 (1)	3.18	D-R	0 / 2048 0.25 (1)	
AB-F	-7499 / 0	-91.8	-91.8 0.48 (1)	3.18	Q-H	-770 / 0 0.10 (1)	
F-AC	-7498 / 0	-91.8	-91.8 0.48 (1)	3.18	R-E	-769 / 0 0.10 (1)	
AC-G	-7498 / 0	-91.8	-91.8 0.48 (1)	3.18	R-F	-141 / 0 0.03 (1)	
G-H	-7498 / 0	-91.8	-91.8 0.48 (1)	3.18	F-Q	-161 / 0 0.03 (1)	
H-AD	-7498 / 0	-91.8	-91.8 0.77 (1)	3.05			
AD-AE	-7498 / 0	-91.8	-91.8 0.77 (1)	3.05			
AE-AF	-7498 / 0	-91.8	-91.8 0.77 (1)	3.05			
AF-I	-7486 / 0	-91.8	-91.8 0.77 (1)	3.05			
I-AG	-5710 / 0	-91.8	-91.8 0.50 (1)	3.59			
AG-AH	-5710 / 0	-91.8	-91.8 0.50 (1)	3.59			
AH-J	-5710 / 0	-91.8	-91.8 0.50 (1)	3.59			
J-K	-3935 / 0	-91.8	-91.8 0.22 (1)	4.59			
K-L	0 / 35	-91.8	-91.8 0.07 (1)	10.00			
V-B	-3345 / 0	0.0	0.0 0.19 (1)	6.38			
M-K	-3288 / 0	0.0	0.0 0.18 (1)	6.42			
V-AI	0 / 0	-18.5	-18.5 0.03 (4)	10.00			
AI-U	0 / 0	-18.5	-18.5 0.03 (4)	10.00			
U-AJ	0 / 3315	-18.5	-18.5 0.24 (1)	10.00			
AJ-AK	0 / 3315	-18.5	-18.5 0.24 (1)	10.00			
AK-T	0 / 3315	-18.5	-18.5 0.24 (1)	10.00			
T-AL	0 / 5749	-18.5	-18.5 0.44 (1)	10.00			
AL-S	0 / 5749	-18.5	-18.5 0.44 (1)	10.00			
S-AM	0 / 5749	-18.5	-18.5 0.44 (1)	10.00			
AM-R	0 / 5749	-18.5	-18.5 0.44 (1)	10.00			
R-AN	0 / 7589	-18.5	-18.5 0.57 (1)	10.00			
AN-AO	0 / 7589	-18.5	-18.5 0.57 (1)	10.00			
AO-AP	0 / 7589	-18.5	-18.5 0.57 (1)	10.00			
AP-Q	0 / 7589	-18.5	-18.5 0.57 (1)	10.00			
Q-AQ	0 / 5710	-18.5	-18.5 0.43 (1)	10.00			
AQ-P	0 / 5710	-18.5	-18.5 0.43 (1)	10.00			
P-AR	0 / 5710	-18.5	-18.5 0.43 (1)	10.00			
AR-AS	0 / 5710	-18.5	-18.5 0.43 (1)	10.00			

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***

GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.

LOADS WERE DERIVED FROM USER INPUT

NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')

CALCULATED VERT. DEFL.(LL) = L/989 (0.23')

ALLOWABLE DEFL.(TL) = L/360 (1.17')

CALCULATED VERT. DEFL.(TL) = L/984 (0.44')

CSI: TC=0.77/1.00 (H-I:1), BC=0.57/1.00 (Q-R:1), WB=0.42/1.00 (B-U:1), CSI=0.20/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	818 354 1667 788 1987 1666	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.73 (G) INPUT = 0.90 I

JSI METAL = 0.57 (S) INPUT = 1.00 I



Structural component only

DWG# T-2008982 1/2

PLATES (table la in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TTWW+m	MT20	7.0	8.0	Edge	2.50
D	TMVW-t	MT20	4.0	6.0		
E	TMVW-w	MT20	2.0	4.0		
F	TMVW-t	MT20	4.0	4.0		
G	TS-t	MT20	3.0	6.0		
H	TMVW-w	MT20	2.0	4.0		
I	TMVW-t	MT20	4.0	6.0		
J	TTWW+m	MT20	7.0	8.0	Edge	2.50
K	TMVW-p	MT20	5.0	8.0	Edge	3.50
M	BMVW-p	MT20	3.0	6.0		
N	BMVW-t	MT20	5.0	6.0	2.50	2.50
O	BMVW-t	MT20	5.0	6.0	4.00	2.00
P	BS-t	MT20	5.0	6.0		
Q	BMVW-w	MT20	5.0	8.0		
R	BMVW-w	MT20	5.0	8.0		
S	BS-t	MT20	5.0	6.0		
T	BMVW-t	MT20	5.0	8.0	4.00	2.00
U	BMVW-t	MT20	5.0	6.0	2.50	2.50
V	BMVW-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)

CHORDS


MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB. MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO					
AS-O	0: 5710	-18.5	-18.5	0.43 (1)	10.00		
O-AT	0: 3251	-18.5	-18.5	0.23 (1)	10.00		
AT-AU	0: 3251	-18.5	-18.5	0.23 (1)	10.00		
AU-N	0: 3251	-18.5	-18.5	0.23 (1)	10.00		
N-AV	0: 0	-18.5	-18.5	0.03 (4)	10.00		
AV-AW	0: 0	-18.5	-18.5	0.03 (4)	10.00		
AW-M	0: 0	-18.5	-18.5	0.03 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)


JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-11	-49	-55		FRONT	VERT	DEAD		C1
C	4-0-11	-117	-117		BACK	VERT	TOTAL		C1
C	4-0-11	-264	-264		FRONT	VERT	SNOW		C1
Q	19-11-4	-110	-110		BACK	VERT	TOTAL		C1
J	31-1-6	-49	-55		FRONT	VERT	DEAD		C1
J	31-1-6	-254	-254		FRONT	VERT	SNOW		C1
S	11-11-4	-26	-26		BACK	VERT	TOTAL		C1
U	3-11-4	-26	-26		BACK	VERT	TOTAL		C1
W	5-11-4	-110	-110		BACK	VERT	TOTAL		C1
X	7-11-4	-110	-110		BACK	VERT	TOTAL		C1
Y	9-11-4	-110	-110		BACK	VERT	TOTAL		C1
Z	11-11-4	-110	-110		BACK	VERT	TOTAL		C1
AA	13-11-4	-110	-110		BACK	VERT	TOTAL		C1
AB	15-11-4	-110	-110		BACK	VERT	TOTAL		C1
AC	17-11-4	-110	-110		BACK	VERT	TOTAL		C1
AD	21-11-4	-110	-110		BACK	VERT	TOTAL		C1
AE	23-11-4	-110	-110		BACK	VERT	TOTAL		C1
AF	25-11-4	-110	-110		BACK	VERT	TOTAL		C1
AG	27-11-4	-110	-110		BACK	VERT	TOTAL		C1
AH	29-11-4	-110	-110		BACK	VERT	TOTAL		C1
AI	1-11-4	-26	-26		BACK	VERT	TOTAL		C1
AJ	5-11-4	-26	-26		BACK	VERT	TOTAL		C1
AK	7-11-4	-26	-26		BACK	VERT	TOTAL		C1
AL	9-11-4	-26	-26		BACK	VERT	TOTAL		C1
AM	13-11-4	-26	-26		BACK	VERT	TOTAL		C1
AN	15-11-4	-26	-26		BACK	VERT	TOTAL		C1
AO	17-11-4	-26	-26		BACK	VERT	TOTAL		C1
AP	19-11-4	-26	-26		BACK	VERT	TOTAL		C1
AQ	21-11-4	-26	-26		BACK	VERT	TOTAL		C1
AR	23-11-4	-26	-26		BACK	VERT	TOTAL		C1
AS	25-11-4	-26	-26		BACK	VERT	TOTAL		C1
AT	27-11-4	-26	-26		BACK	VERT	TOTAL		C1
AU	29-11-4	-26	-26		BACK	VERT	TOTAL		C1
AV	31-11-4	-26	-26		BACK	VERT	TOTAL		C1
AW	33-11-4	-26	-26		BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

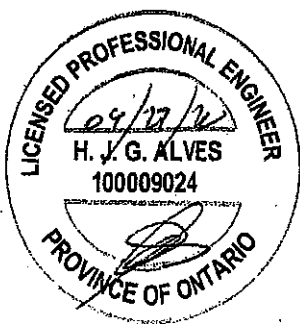

Structural component only
 DWG# T-2006982 42

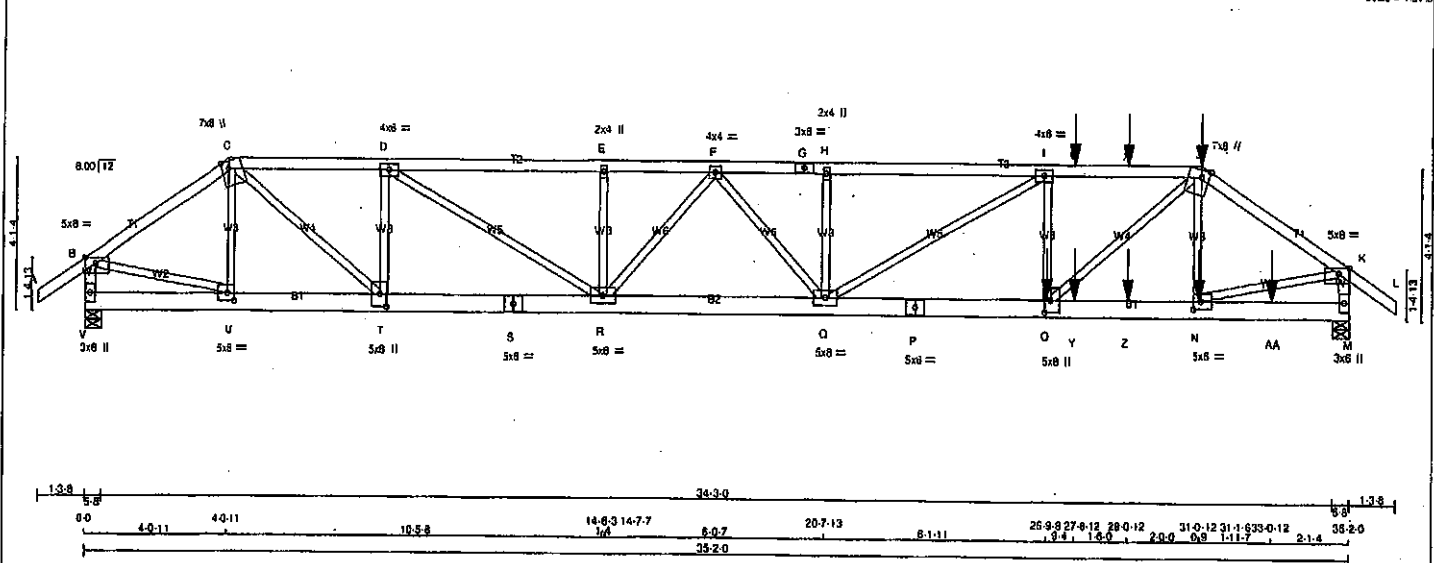

TOTAL WEIGHT = 2 X 160 = 321 b

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
J - L	2x4	DRY	No.2
V - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
V - S	2x6	DRY	No.2
S - P	2x6	DRY	No.2
P - M	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C 1	12	TOP
C-G 1	12	TOP
G-J 1	12	SIDE(81.0)
J-L 1	12	SIDE(81.0)
V-B 1	12	TOP
M-K 1	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
V-S 2	12	TOP
S-P 2	12	TOP
P-M 2	12	SIDE(183.1)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1	6	
I-O 1	5	SIDE(352.8)
O-T 1	5	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
V	2660	0	2660	0
M	4269	0	4269	0

UNFACTORED REACTIONS

	1ST LOASE	MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERMLIVE	WIND	DEAD	SOIL
V	1879	1243 / 0	0 / 0	0 / 0	0 / 0	636 / 0	0 / 0
M	3018	1988 / 0	0 / 0	0 / 0	0 / 0	1033 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.14 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORZ. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MAX. FACTORED UPLIFT (LBS)
FR-TO		FROM TO	CSI (LC)	FR-TO			
A-B	0 / 35	-91.8	-91.8	0.07 (1)	U-C	-525 / 0	0.07 (1)
B-C	-3062 / 0	-91.8	-91.8	0.18 (1)	C-T	0 / 2290	0.38 (1)
C-D	-4727 / 0	-91.8	-91.8	0.31 (1)	T-D	-1780 / 0	0.23 (1)
D-E	-6774 / 0	-91.8	-91.8	0.53 (1)	O-J	-767 / 0	0.10 (1)
E-F	-6774 / 0	-91.8	-91.8	0.32 (1)	J-Q	0 / 4417	0.11 (1)
F-G	-7769 / 0	-91.8	-91.8	0.37 (1)	N-K	0 / 2615	0.08 (1)
G-H	-7769 / 0	-91.8	-91.8	0.37 (1)	B-U	0 / 4430	0.08 (1)
H-I	-7769 / 0	-91.8	-91.8	0.68 (1)	Q-I	0 / 159	0.02 (1)
I-W	-7833 / 0	-91.8	-91.8	0.51 (1)	D-R	0 / 2395	0.30 (1)
W-X	-7833 / 0	-91.8	-91.8	0.51 (1)	Q-H	-461 / 0	0.08 (1)
X-J	-7833 / 0	-91.8	-91.8	0.51 (1)	R-E	-472 / 0	0.08 (1)
K-L	-5186 / 0	-91.8	-91.8	0.27 (1)	F-Q	0 / 678	0.08 (1)
K-L	0 / 35	-91.8	-91.8	0.07 (1)			
V-B	-2628 / 0	0.0	0.0	0.15 (1)			
M-K	-4232 / 0	0.0	0.0	0.24 (1)			

V-U	0 / 0	-18.5	-18.5	0.02 (4)	10.00
U-T	0 / 2529	-18.5	-18.5	0.17 (1)	10.00
T-S	0 / 4727	-18.5	-18.5	0.38 (1)	10.00
S-R	0 / 4727	-18.5	-18.5	0.38 (1)	10.00
R-Q	0 / 7338	-18.5	-18.5	0.53 (1)	10.00
Q-P	0 / 7633	-18.5	-18.5	0.57 (1)	10.00
P-O	0 / 7633	-18.5	-18.5	0.57 (1)	10.00
O-Y	0 / 4284	-18.5	-18.5	0.34 (1)	10.00
Y-Z	0 / 4284	-18.5	-18.5	0.34 (1)	10.00
Z-N	0 / 4284	-18.5	-18.5	0.34 (1)	10.00
N-AA	0 / 0	-18.5	-18.5	0.03 (4)	10.00
AA-M	0 / 0	-18.5	-18.5	0.03 (4)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
J	31-1-8	-49	-55	---	FRONT	VERT	DEAD	C1
J	31-1-8	-118	-118	---	FRONT	VERT	TOTAL	C1
N	31-1-8	-254	-254	---	FRONT	VERT	SNOW	C1
N	31-0-12	-26	-26	---	FRONT	VERT	TOTAL	C1
O	26-9-8	-2054	-2054	---	FRONT	VERT	TOTAL	C1
W	27-8-12	-110	-110	---	FRONT	VERT	TOTAL	C1
X	29-0-12	-110	-110	---	FRONT	VERT	TOTAL	C1
Y	27-6-12	-26	-26	---	FRONT	VERT	TOTAL	C1
Z	29-0-12	-26	-26	---	FRONT	VERT	TOTAL	C1
AA	33-0-12	-26	-26	---	FRONT	VERT	TOTAL	C1

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.23")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/982 (0.43")

CSI: TC=0.88/1.00 (H-I), BC=0.57/1.00 (O-Q), WB=0.55/1.00 (K-N), SS=0.18/1.00 (J-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.72 (P) (INPUT = 1.00)

Structural component only
DWG# T-2006983 1/2



JOB NAME 408088	TRUSS NAME T100Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 09:03:39 2020 Page 2 ID:DMCubINVR6TstFoe3Iv6I zns1t-olnl3xUv9g7UcvOcnVdsXSMC14NlwJhI 1UGzNEXI	


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TTWW+m	MT20	7.0	8.0	Edge	2.50
D	TMWW-t	MT20	4.0	8.0		
E	TMW+w	MT20	2.0	4.0		
F	TMWW-l	MT20	4.0	4.0		
G	TS-t	MT20	3.0	8.0		
H	TMW+w	MT20	2.0	4.0		
I	TMWW-l	MT20	4.0	6.0		
J	TTWW+m	MT20	7.0	8.0	Edge	2.50
K	TMVW-p	MT20	5.0	8.0	Edge	3.50
M	BMV1+p	MT20	3.0	6.0		
N	BMWW-l	MT20	5.0	6.0	2.50	2.50
O	BMWW+l	MT20	5.0	8.0	4.00	2.00
P	SS-l	MT20	5.0	6.0		
Q	BMWWW-l	MT20	5.0	8.0		
R	BMWWW-l	MT20	5.0	8.0		
S	SS-l	MT20	5.0	8.0		
T	BMWW+l	MT20	5.0	8.0	4.00	2.00
U	BMWW-l	MT20	5.0	8.0	2.50	2.50
V	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

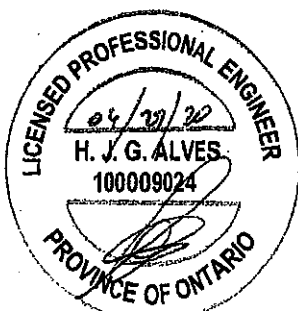


Structural component only
DWG# T-2006983 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408087	T2	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 08:53:16 2020 Page 1
ID:DMCubINVR6TsUfQe31v6l_zns11-XSdn72OldkAPesmlRqX69orNvQSPCoRIZZ7izNEh1

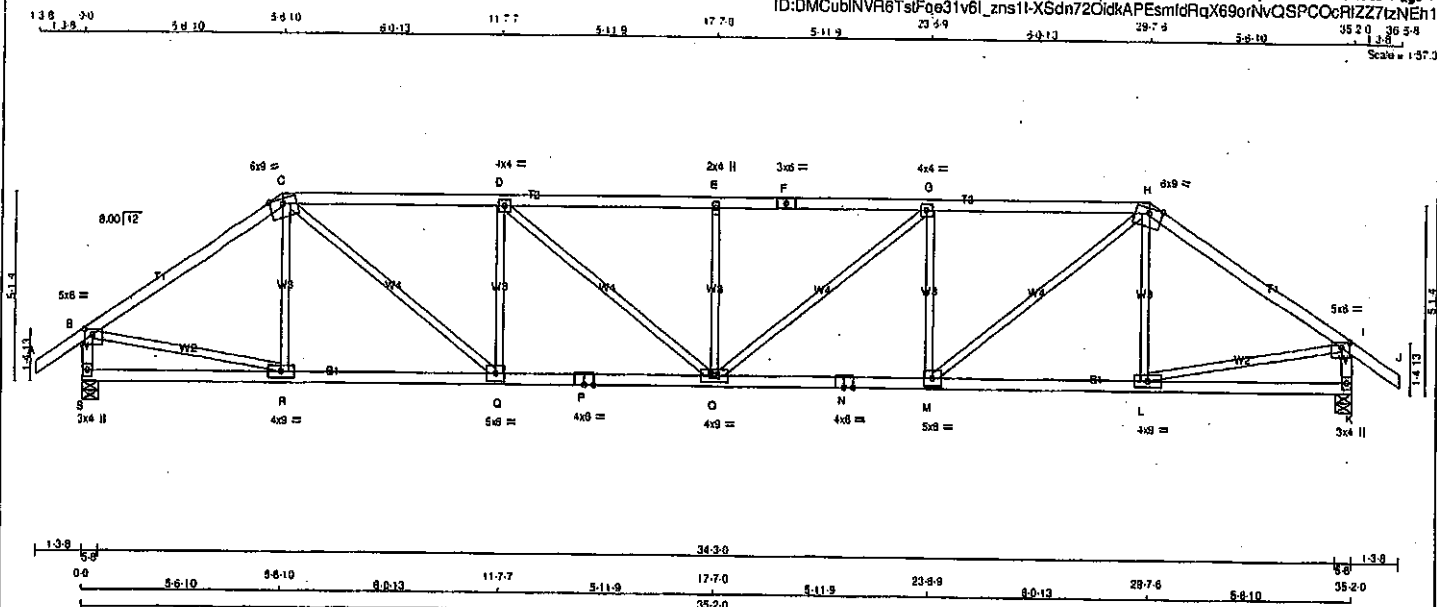

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
S - P	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.75	2.75
C	TTWW-m	MT20	6.0	9.0	Edge	
D	TMVW-l	MT20	4.0	4.0		
E	TMVW-w	MT20	2.0	4.0		
F	TS-l	MT20	3.0	8.0		
G	TMVW-l	MT20	4.0	4.0		
H	TTWW-m	MT20	6.0	9.0	Edge	
I	TMVW-p	MT20	5.0	8.0	1.75	2.75
K	BMV1-p	MT20	3.0	4.0		
L	BMVW-l	MT20	4.0	9.0		
M	BMVW-l	MT20	5.0	8.0		
N	BS-l	MT20	4.0	6.0		
O	BMVW-l	MT20	4.0	9.0		
P	BS-l	MT20	4.0	6.0		
Q	BMVW-l	MT20	5.0	8.0		
R	BMVW-l	MT20	4.0	9.0		
S	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REORD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
S	2065	0	2065	0	0	5-8
K	2065	0	2065	0	0	5-8

UNFACTORED REACTIONS

	1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
K	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-61.8	-61.8 0.12 (1)	10.00	R-C	-243 / 10	0.09 (1)
B-C	-2297 / 0	-61.8	-61.8 0.70 (1)	3.78	C-Q	0 / 1670	0.38 (1)
C-D	-3214 / 0	-61.8	-61.8 0.80 (1)	3.18	Q-D	-929 / 0	0.38 (1)
D-E	-3595 / 0	-61.8	-61.8 0.88 (1)	2.97	D-D	0 / 490	0.11 (4)
E-F	-3595 / 0	-61.8	-61.8 0.88 (1)	2.97	C-E	-505 / 0	0.19 (1)
F-G	-3595 / 0	-61.8	-61.8 0.88 (1)	2.97	C-G	0 / 490	0.11 (1)
G-H	-3214 / 0	-61.8	-61.8 0.80 (1)	3.18	M-H	-929 / 0	0.38 (1)
H-I	-2297 / 0	-61.8	-61.8 0.70 (1)	3.78	L-H	0 / 1670	0.38 (1)
I-J	0 / 35	-61.8	-61.8 0.12 (1)	10.00	L-I	-243 / 10	0.09 (1)
S-B	-2023 / 0	0.0	0.0 0.21 (1)	5.94	B-R	0 / 1943	0.44 (1)
K-I	-2023 / 0	0.0	0.0 0.21 (1)	5.94	L-I	0 / 1943	0.44 (1)

S-R	0 / 0	-18.5	-18.5 0.15 (4)	10.00
R-Q	0 / 1904	-18.5	-18.5 0.39 (1)	10.00
Q-P	0 / 3214	-18.5	-18.5 0.58 (1)	10.00
P-O	0 / 3214	-18.5	-18.5 0.58 (1)	10.00
O-N	0 / 3214	-18.5	-18.5 0.58 (1)	10.00
N-M	0 / 3214	-18.5	-18.5 0.58 (1)	10.00
M-L	0 / 1904	-18.5	-18.5 0.39 (1)	10.00
L-K	0 / 0	-18.5	-18.5 0.15 (4)	10.00

TOTAL WEIGHT = 2 X 140 = 280 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF

BOT CH. LL = 0.0 PSF
DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN PLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CSI: TC=0.88/1.00 (E-G:1), BC=0.58/1.00 (O-Q:1), WB=0.44/1.00 (B-R:1), SS=0.28/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354
	1697	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.87 (B) (INPUT = 0.90)
JSI METAL = 0.74 (F) (INPUT = 1.00)

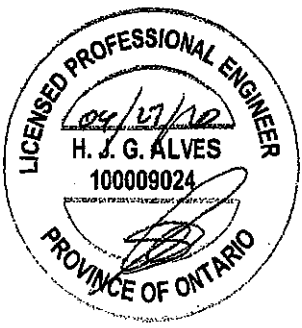

Structural component only
DWG# T-2006954

JOB NAME 408087	TRUSS NAME T3	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 08:53:16 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-XSdn720kKAPesmtRqX69aw0vSsP37cRIZZ7zNEh1
Scale = 1:37.3

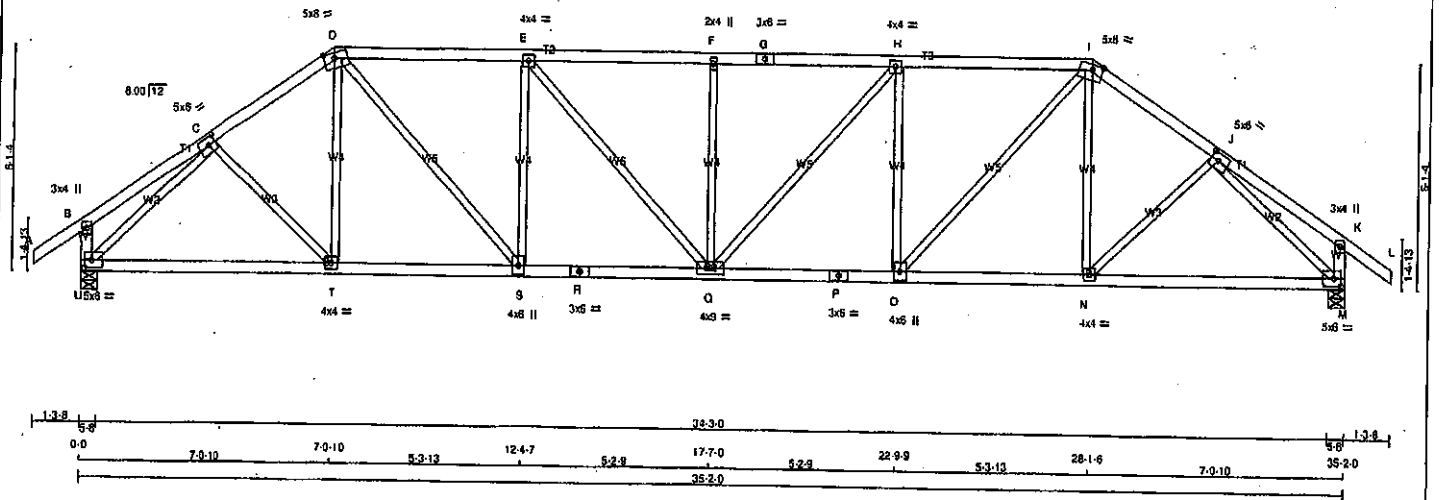


LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
G - I	2x4	DRY	No.2
J - L	2x4	DRY	No.2
U - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMWW-t	MT20	5.0	6.0	2.50 2.50
D	TTWW-m	MT20	5.0	8.0	1.75 3.50
E	TMWW-t	MT20	4.0	4.0	
F	TMWW-w	MT20	2.0	4.0	
G	TS-t	MT20	3.0	6.0	
H	TMWW-t	MT20	4.0	4.0	
I	TTWW-m	MT20	5.0	8.0	1.75 3.50
J	TMWW-t	MT20	5.0	6.0	2.50 2.50
K	TMV+p	MT20	3.0	4.0	
M	BMVW1-t	MT20	5.0	8.0	2.50 2.25
N	BMWW-t	MT20	4.0	4.0	
O	BMWW-t	MT20	4.0	6.0	
P	BS-t	MT20	3.0	6.0	
Q	BMWW-t	MT20	4.0	9.0	
R	BS-t	MT20	3.0	6.0	
S	BMWW-t	MT20	4.0	6.0	
T	BMWW-t	MT20	4.0	4.0	
U	BMVW1-t	MT20	5.0	8.0	2.50 2.25

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
	FACTORED	MAXIMUM FACTORED	INPUT	RECORD					
	GROSS REACTION	GROSS REACTION	BRG	BRG					
JT	VERT	HORZ	DOWN	UPLIFT	IN-SX	IN-SX			
U	2065	0	2065	0	5-8	5-8			
M	2065	0	2065	0	5-8	5-8			
UNFACTORED REACTIONS									
	1ST LOASE	MAX MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL		
U	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0		
M	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0		
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M									
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.53 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.									

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS									
MEMB.	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED	MEMB.	MAX. FACTORED	WEBS	MAX. FACTORED	MEMB.
	FORCE (LBS)	VERT. LOAD (PLF)	CS1 (LC)	UNBRAC		FORCE (LBS)	CS1 (LC)	UNBRAC	
FR-TO		FROM TO	LENGTH	FR-TO					
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	C-T	0 / 135	0.03 (4)		
B-C	0 / 18	-91.8	-91.8 0.18 (1)	10.00	T-D	0 / 80	0.03 (4)		
C-D	-2308 / 0	-91.8	-91.8 0.23 (1)	4.31	D-S	0 / 1218	0.27 (1)		
D-E	-2724 / 0	-91.8	-91.8 0.54 (1)	3.69	S-E	-814 / 0	0.48 (1)		
E-F	-2987 / 0	-91.8	-91.8 0.58 (1)	3.53	E-Q	0 / 383	0.08 (1)		
F-G	-2987 / 0	-91.8	-91.8 0.58 (1)	3.53	Q-F	-440 / 0	0.26 (1)		
G-H	-2987 / 0	-91.8	-91.8 0.58 (1)	3.53	C-H	-814 / 0	0.48 (1)		
H-I	-2724 / 0	-91.8	-91.8 0.54 (1)	3.69	C-I	0 / 1218	0.27 (1)		
I-J	-2308 / 0	-91.8	-91.8 0.23 (1)	4.31	C-I	0 / 80	0.03 (4)		
J-K	0 / 18	-91.8	-91.8 0.18 (1)	10.00	N-J	0 / 135	0.03 (4)		
K-L	0 / 35	-91.8	-91.8 0.12 (1)	10.00	N-J	-2515 / 0	0.97 (1)		
U-B	-255 / 0	0.0	0.0 0.03 (1)	7.81	U-C	-2515 / 0	0.97 (1)		
M-K	-255 / 0	0.0	0.0 0.03 (1)	7.81	J-M	-2515 / 0	0.97 (1)		
U-T	0 / 1802	-18.5	-18.5 0.40 (1)	10.00					
T-S	0 / 1901	-18.5	-18.5 0.41 (1)	10.00					
S-R	0 / 2724	-18.5	-18.5 0.49 (1)	10.00					
R-Q	0 / 2724	-18.5	-18.5 0.49 (1)	10.00					
Q-P	0 / 2724	-18.5	-18.5 0.49 (1)	10.00					
P-O	0 / 2724	-18.5	-18.5 0.49 (1)	10.00					
O-N	0 / 1901	-18.5	-18.5 0.41 (1)	10.00					
N-M	0 / 1802	-18.5	-18.5 0.40 (1)	10.00					


DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF
SPACING = 24.0 IN. GC	
LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12	
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015	
THIS DESIGN COMPLIES WITH:	
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019	
- PART 9 OF CBC 2012 (2019 AMENDMENT)	
- CSA 086-09, CSA 088-14	
- TPIC 2011, TPIC 2014	
(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.8 P.S.F. SPECIFIED ROOF LIVE LOAD	
ALLOWABLE DEFL.(LL) = L/360 (1.17")	
CALCULATED VERT. DEFL.(LL) = L/999 (0.16")	
ALLOWABLE DEFL.(TL) = L/360 (1.17")	
CALCULATED VERT. DEFL.(TL) = L/999 (0.23")	
CSI: TC=0.58/1.00 (E-F); BC=0.49/1.00 (Q-S); WB=0.97/1.00 (C-U); SS=0.23/1.00 (D-E);	
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10	
COMP=1.10 SHEAR=1.10 TENS=1.10	
COMPANION LIVE LOAD FACTOR = 1.00	
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.	
NAIL VALUES	
PLATE GRIP(DRY) SHEAR SECTION	
(PSI) (PLI) (PLI)	
MAX MIN MAX MIN MAX MIN	
MT20 618 354 1667 788 1987 1656	
PLATE PLACEMENT TOL. = 0.250 inches	
PLATE ROTATION TOL. = 5.0 Deg.	
JSI GRIP= 0.90 (U) (INPUT = 0.90)	
JSI METAL= 0.84 (P) (INPUT = 1.00)	

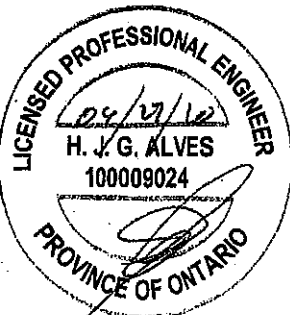

Structural component only
DWG# T-2006955

JOB NAME 408087	TRUSS NAME T4	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	ORWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Sat Apr 25 08:53:17 2020 Page 1
ID:DMCubINVR6TsiF0a31v6l_zns11-0eB9KOPKO2IGs0LrA8LmIMK3SioP8dKlfyJ7fJzNEh0

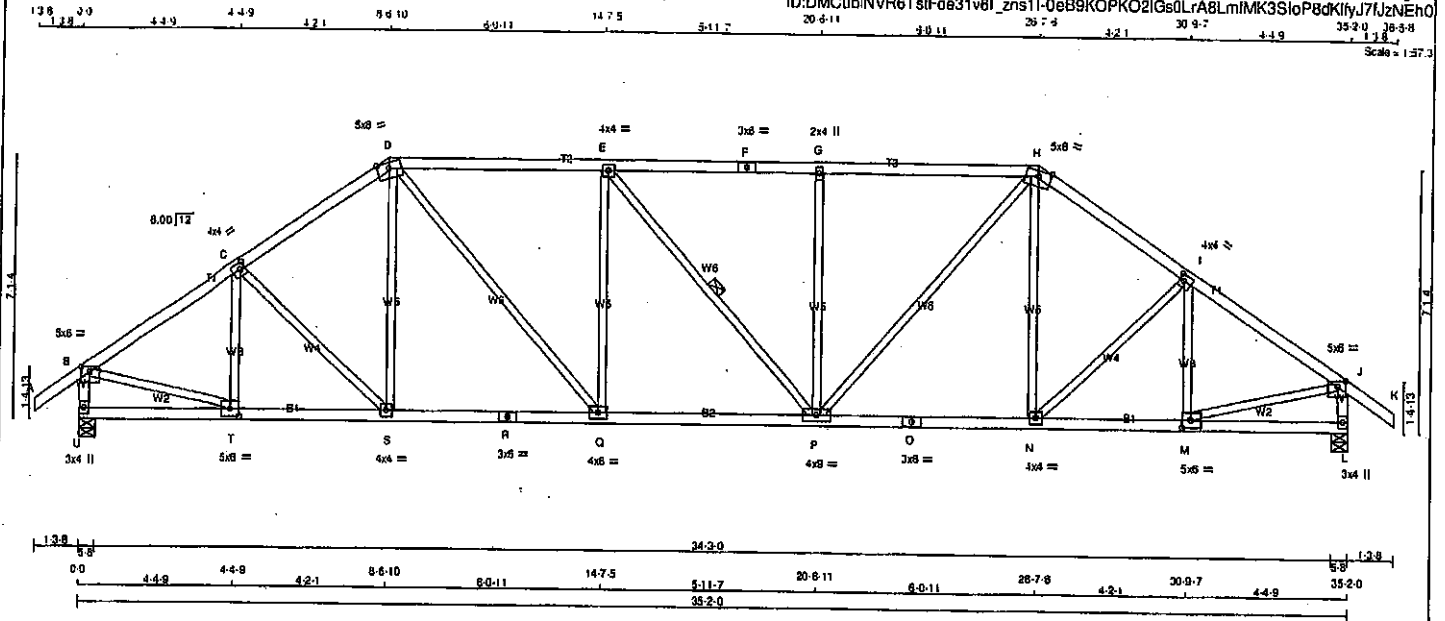

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0	6.0 1.75 2.75
C	TMVW-l	MT20	4.0	4.0 2.00 1.50
D	TTWV-m	MT20	5.0	6.0 Edge
E	TMVW-l	MT20	4.0	4.0
F	TS-l	MT20	3.0	6.0
G	TMVW-w	MT20	2.0	4.0
H	TTWV-m	MT20	5.0	6.0 Edge
I	TMVW-l	MT20	4.0	4.0 2.00 1.50
J	TMVW-p	MT20	5.0	6.0 1.75 2.75
L	BMV1+p	MT20	3.0	4.0
M	BMVW-l	MT20	5.0	6.0 2.50 2.75
N	BMVW-l	MT20	4.0	4.0
O	BS-l	MT20	3.0	6.0
P	BMVWW-l	MT20	4.0	9.0
Q	BMVW-l	MT20	4.0	6.0
R	BS-l	MT20	3.0	6.0
S	BMVW-l	MT20	4.0	4.0
T	BMVW-l	MT20	5.0	6.0 2.50 2.75
U	BMV1+p	MT20	3.0	4.0


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
	FACTORED	MAXIMUM FACTORED	INPUT	REQD			
	GROSS REACTION	GROSS REACTION	BRG	BRG			
JT	VERT	HORZ	DOWN	UPLIFT	IN-SX	IN-SX	
U	2085	0	2085	0	5-8	5-8	
L	2085	0	2085	0	5-8	5-8	
UNFACTORED REACTIONS							
	1ST CASE	MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
U	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0


BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L
BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.
1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-P.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	T-C	-396 / 0	0.11 (1)
B-C	-2270 / 0	-91.8	-91.8 0.37 (1)	4.19	C-S	-79 / 0	0.05 (1)
C-D	-2254 / 0	-91.8	-91.8 0.38 (1)	4.21	S-O	0 / 156	0.04 (4)
D-E	-2485 / 0	-91.8	-91.8 0.64 (1)	3.72	D-Q	0 / 949	-0.21 (1)
E-F	-2484 / 0	-91.8	-91.8 0.64 (1)	3.72	Q-E	-597 / 0	0.52 (1)
F-G	-2484 / 0	-91.8	-91.8 0.64 (1)	3.72	E-P	-2 / 0	0.00 (1)
G-H	-2484 / 0	-91.8	-91.8 0.63 (1)	3.74	P-G	-597 / 0	0.52 (1)
H-I	-2254 / 0	-91.8	-91.8 0.38 (1)	4.21	P-H	0 / 947	0.21 (1)
I-J	-2270 / 0	-91.8	-91.8 0.37 (1)	4.19	N-H	0 / 157	0.04 (4)
J-K	0 / 35	-91.8	-91.8 0.12 (1)	10.00	N-I	-79 / 0	0.05 (1)
U-B	-2027 / 0	0.0	0.0 0.21 (1)	5.94	M-I	-387 / 0	0.11 (1)
L-J	-2026 / 0	0.0	0.0 0.21 (1)	5.94	B-T	0 / 1968	0.44 (1)
					M-J	0 / 1968	0.44 (1)
U-T	0 / 0	-18.5	-18.5 0.08 (4)	10.00			
T-S	0 / 1909	-18.5	-18.5 0.37 (1)	10.00			
S-R	0 / 1854	-18.5	-18.5 0.38 (1)	10.00			
R-Q	0 / 1854	-18.5	-18.5 0.38 (1)	10.00			
Q-P	0 / 2485	-18.5	-18.5 0.47 (1)	10.00			
P-O	0 / 1854	-18.5	-18.5 0.38 (1)	10.00			
O-N	0 / 1854	-18.5	-18.5 0.38 (1)	10.00			
N-M	0 / 1909	-18.5	-18.5 0.37 (1)	10.00			
M-L	0 / 0	-18.5	-18.5 0.08 (4)	10.00			

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 28.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN. GIC
LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015
THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014
(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD
ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")
CSI: TC=0.84/1.00 (D-E:1), BC=0.47/1.00 (P-Q:1), WB=0.52/1.00 (E-Q:1), SS=0.28/1.00 (D-E:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10
COMPANION LIVE LOAD FACTOR = 1.00
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP = 0.90 (D) (INPUT = 0.90)
JSI METAL = 0.82 (O) (INPUT = 1.00)



Structural component only
DWG# T-2006956

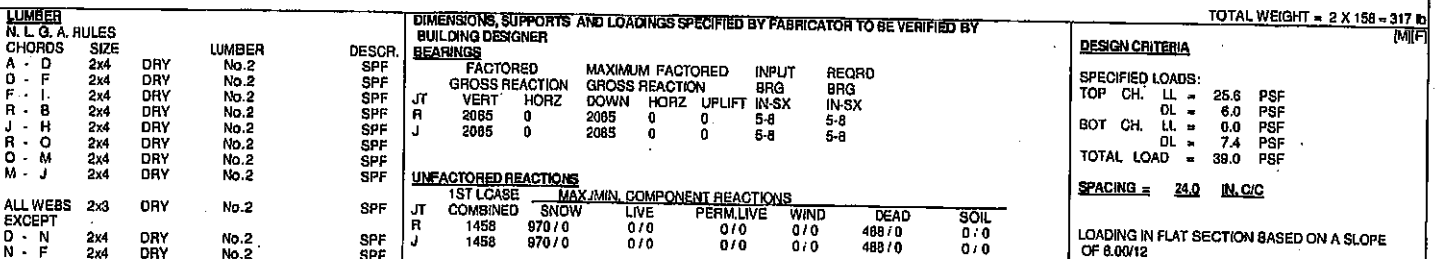

PLATES (tablets in inches)

J	T	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	6.0	1.75	2.75
C	TMWV-I	MT20	4.0	4.0	2.00	1.50
D	TTWV-m	MT20	5.0	6.0	2.25	1.75
E	TMW+u	MT20	2.0	4.0		
F	TTWV-m	MT20	5.0	6.0	2.25	1.75
G	TMWV-I	MT20	4.0	4.0	2.00	1.50
H	TMWV-p	MT20	5.0	6.0	1.75	2.75
J	BMV1+p	MT20	3.0	4.0		
K	SMWV-I	MT20	5.0	6.0	2.50	2.75
L	BMWV-I	MT20	4.0	4.0		
M	BS-I	MT20	3.0	8.0		
N	BMWVW-I	MT20	4.0	3.0		
O	BS-I	MT20	3.0	6.0		
P	SMWV-I	MT20	4.0	4.0		
Q	BMWV-I	MT20	5.0	6.0	2.50	2.75
R	SMV1+p	MT20	3.0	4.0		

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
R	2085	0	2085	0	0	5-8	5-8
J	2085	0	2085	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
J	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B. J.

ERACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX (PLF)	MAX. UNBHAC	MEMB.	FORCE (LBS)	MAX (CSI (L))
FR-TO		FROM	TO	LENGTH	FR-TO		
A-B	0 135	-91.8	-91.8	0.12 (1)	10.00	Q-C	-321 / 0 0.11 (1)
B-C	-2318 / 0	-91.8	-91.8	0.38 (1)	4.18	C-Q	-218 / 0 0.18 (1)
C-D	0 1794	-91.8	-91.8	0.37 (1)	4.28	P-D	0 / 266 0.06 (1)
D-E	0 2186 / 0	-91.8	-91.8	0.81 (1)	3.47	P-O	0 / 892 0.11 (1)
E-F	0 2275 / 0	-91.8	-91.8	0.37 (1)	3.47	N-E	-851 / 0 0.35 (1)
F-G	0 2186 / 0	-91.8	-91.8	0.37 (1)	4.18	N-F	0 / 892 0.11 (1)
G-H	-2318 / 0	-91.8	-91.8	0.38 (1)	4.18	L-F	0 / 266 0.06 (1)
H-I	0 1794	-91.8	-91.8	0.12 (1)	10.00	L-G	-218 / 0 0.18 (1)
R-B	-2022 / 0	0.0	0.0	0.21 (1)	5.94	K-G	-321 / 0 0.11 (1)
J-H	-2022 / 0	0.0	0.0	0.21 (1)	5.94	Q-Q	0 / 1996 0.45 (1)
						K-H	0 / 1996 0.45 (1)
R-Q	0 / 0	-18.5	-18.5	0.10 (4)	10.00		
Q-P	0 / 1953	-18.5	-18.5	0.40 (1)	10.00		
P-O	0 / 1794	-18.5	-18.5	0.41 (1)	10.00		
O-N	0 / 1794	-18.5	-18.5	0.41 (1)	10.00		
N-M	0 / 1794	-18.5	-18.5	0.41 (1)	10.00		
M-L	0 / 1794	-18.5	-18.5	0.41 (1)	10.00		
L-K	0 / 1953	-18.5	-18.5	0.40 (1)	10.00		
K-J	0 / 0	-18.5	-18.5	0.10 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	UL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	UL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 8.00V12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL)= L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSI: TC=0.81/1.00 (D-E:1), BC=0.41/1.00 (N-P:1),
WB=0.45/1.00 (B-Q:1), SSI=0.34/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	818	354	1067	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (B) (INPUT = 0.90)
JSI METAL= 0.57 (O) (INPUT = 1.00)




Structural component only
DWG# T-2006957

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408087	T6	2	1	TRUSS DESC.		

Yamereck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 08:53:19 2020 Page 1
ID:DMCubINVR6TstFoe31v8l_zns11-y1Jw14RavYz5KVEZOEkRi6V7cXK27G6DKCzNEh

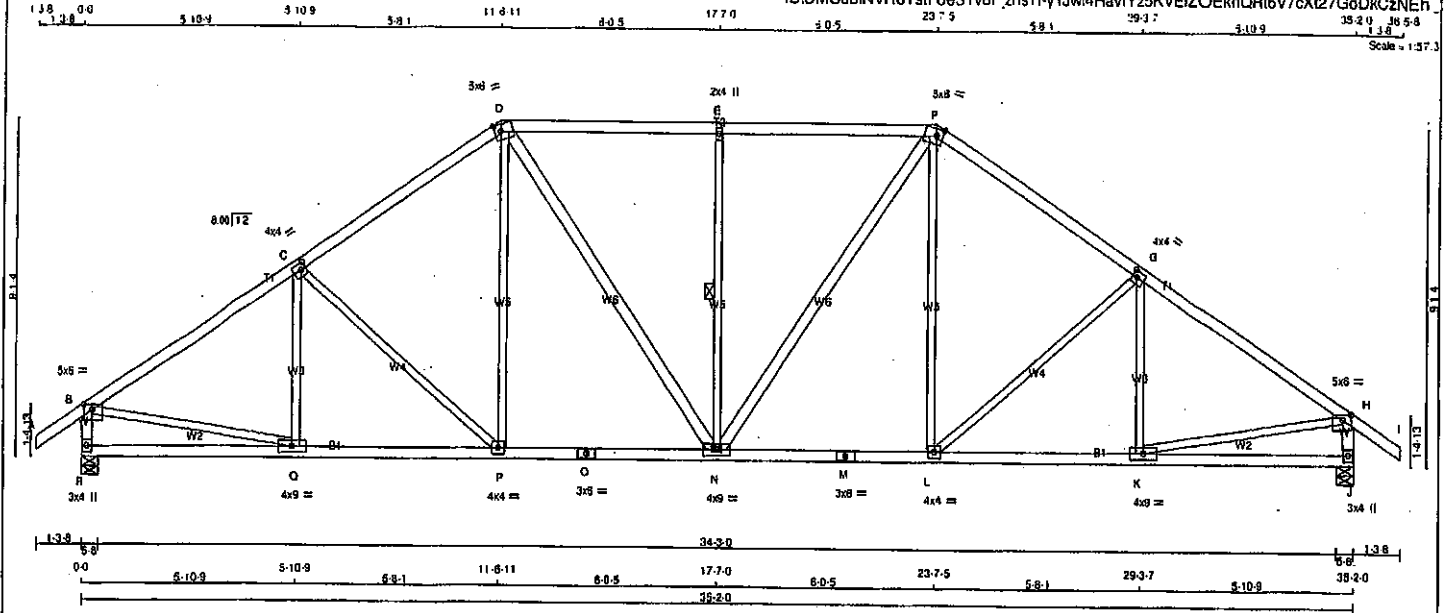

TOTAL WEIGHT = 2 X 165 = 329 lb (M/F)

N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2

ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.75	2.75
C	TMWW-t	MT20	4.0	4.0	2.00	1.50
D	TTWW-m	MT20	5.0	6.0	2.25	2.00
E	TMWW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	5.0	2.25	2.00
G	TMWW-t	MT20	4.0	4.0	2.00	1.50
H	TMVW-p	MT20	5.0	8.0	1.75	2.75
J	BMV1-p	MT20	3.0	4.0		
K	BMWW-t	MT20	4.0	9.0		
L	BMWW-t	MT20	4.0	4.0		
M	BS-t	MT20	3.0	6.0		
N	BMWWW-t	MT20	4.0	9.0		
O	BS-t	MT20	3.0	6.0		
P	BMWW-t	MT20	4.0	4.0		
Q	BMWW-t	MT20	4.0	9.0		
R	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
R	2065	0	2065	0	0	5-8	5-8		
J	2065	0	2065	0	0	5-8	5-8		

UNFACTORED REACTIONS

JT	1ST LOOSE	MAX/MIN. COMPONENT REACTIONS	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
J	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	UNBRACED LENGTH
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	Q-C	-248 / 11	0.11 (1)
B-C	-2347 / 0	-91.8	-91.8 0.52 (1)	3.99	C-P	-358 / 0	0.42 (1)
C-D	-2038 / 0	-91.8	-91.8 0.48 (1)	4.22	P-D	0 / 342	0.08 (1)
D-E	-1985 / 0	-91.8	-91.8 0.49 (1)	4.26	D-N	0 / 477	0.08 (1)
E-F	-1985 / 0	-91.8	-91.8 0.49 (1)	4.26	N-E	-877 / 0	0.37 (1)
F-G	-2096 / 0	-91.8	-91.8 0.48 (1)	4.22	N-F	0 / 477	0.08 (1)
G-H	-2347 / 0	-91.8	-91.8 0.52 (1)	3.99	L-F	-358 / 0	0.08 (1)
H-I	0 / 35	-91.8	-91.8 0.12 (1)	10.00	L-G	-248 / 11	0.11 (1)
R-B	-2018 / 0	0.0	0.0 0.21 (1)	5.94	K-G	-248 / 11	0.11 (1)
J-H	-2018 / 0	0.0	0.0 0.21 (1)	5.94	B-Q	0 / 2014	0.45 (1)
R-Q	0 / 0	-18.5	-18.5 0.14 (4)	10.00	K-H	0 / 2014	0.45 (1)
Q-P	0 / 1981	-18.5	-18.5 0.39 (1)	10.00			
P-O	0 / 1716	-18.5	-18.5 0.34 (1)	10.00			
O-N	0 / 1716	-18.5	-18.5 0.34 (1)	10.00			
N-M	0 / 1716	-18.5	-18.5 0.34 (1)	10.00			
M-L	0 / 1716	-18.5	-18.5 0.34 (1)	10.00			
L-K	0 / 1981	-18.5	-18.5 0.39 (1)	10.00			
K-J	0 / 0	-18.5	-18.5 0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
BOT CH. LL = 6.0 PSF
J. LL = 0.0 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.10")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.19")

CS1: TC=0.52/1.00 (B-C:1), BC=0.39/1.00 (K-L:1), WB=0.45/1.00 (H-K:1), SS=0.27/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (B) (INPUT = 0.90)
JSI METAL = 0.56 (M) (INPUT = 1.00)



Structural component only
DWG# T-2006958

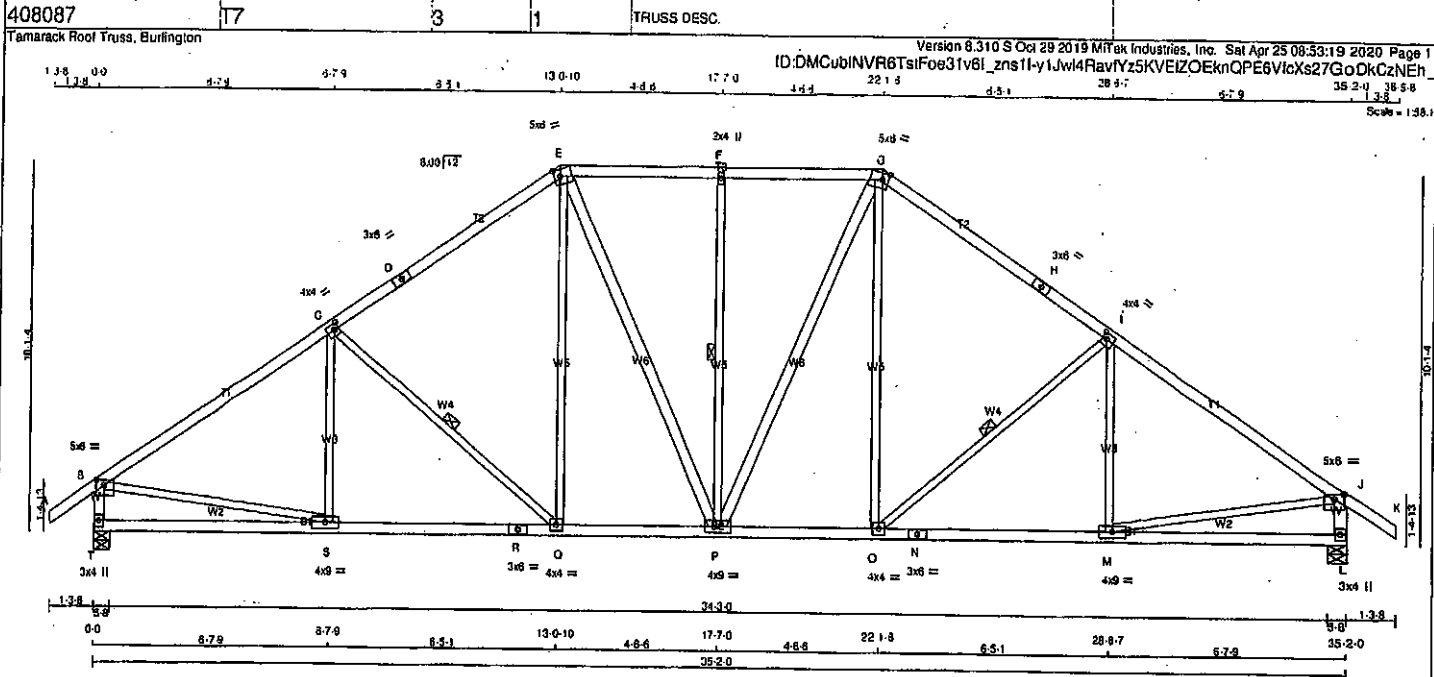

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - H	2x4	DRY	No.2	SPF
H - K	2x4	DRY	No.2	SPF
K - L	2x4	DRY	No.2	SPF
L - M	2x4	DRY	No.2	SPF
M - N	2x4	DRY	No.2	SPF
N - P	2x4	DRY	No.2	SPF
P - Q	2x4	DRY	No.2	SPF
Q - R	2x4	DRY	No.2	SPF
R - S	2x4	DRY	No.2	SPF
S - T	2x4	DRY	No.2	SPF
T - U	2x4	DRY	No.2	SPF
U - V	2x4	DRY	No.2	SPF
V - W	2x4	DRY	No.2	SPF
W - X	2x4	DRY	No.2	SPF
X - Y	2x4	DRY	No.2	SPF
Y - Z	2x4	DRY	No.2	SPF
Z - A	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2

EXCEPT

E - P 2x4 DRY No.2

P - G 2x4 DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	8.0	1.75	2.75
C	TMWV-t	MT20	4.0	4.0	2.00	1.50
D	TS-t	MT20	3.0	8.0		
E	TTWV-m	MT20	5.0	8.0	2.25	2.00
F	TMWV-w	MT20	2.0	4.0		
G	TTWV-m	MT20	5.0	8.0	2.25	2.00
H	TS-t	MT20	3.0	8.0		
I	TMWV-t	MT20	4.0	4.0	2.00	1.50
J	TMWV-p	MT20	5.0	8.0	1.75	2.75
L	BMV1-p	MT20	3.0	4.0		
M	BMWV-t	MT20	4.0	9.0		
N	BS-t	MT20	3.0	6.0		
O	BMWV-t	MT20	4.0	4.0		
P	BMWV-t	MT20	4.0	9.0		
Q	BMWV-t	MT20	4.0	4.0		
R	BS-t	MT20	3.0	6.0		
S	BMWV-t	MT20	4.0	9.0		
T	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT 2065	DOWN 2065	0	5-8
T	0	0	0	5-8
L	0	0	0	5-8

UNFACTORED REACTIONS

	1ST LOASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERMLIVE WIND DEAD SOIL
T	1458	970 / 0 0 / 0 0 / 0 0 / 0 488 / 0 0 / 0
L	1458	970 / 0 0 / 0 0 / 0 0 / 0 488 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-Q, F-P, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	S-C	-189 / 48	0.10 (1)
B-C	-2359 / 0	-91.8	-91.8 0.69 (1)	3.77	C-Q	-485 / 0	0.24 (1)
C-D	-1996 / 0	-91.8	-91.8 0.82 (1)	4.11	Q-E	0 / 416	0.09 (1)
D-E	-1996 / 0	-91.8	-91.8 0.82 (1)	4.11	E-P	0 / 315	0.05 (1)
E-F	-1762 / 0	-91.8	-91.8 0.27 (1)	4.77	P-F	-502 / 0	0.35 (1)
F-G	-1762 / 0	-91.8	-91.8 0.27 (1)	4.77	P-G	0 / 315	0.05 (1)
G-H	-1996 / 0	-91.8	-91.8 0.82 (1)	4.11	O-G	0 / 416	0.09 (1)
H-I	-1996 / 0	-91.8	-91.8 0.82 (1)	4.11	O-I	-485 / 0	0.24 (1)
I-J	-2359 / 0	-91.8	-91.8 0.69 (1)	3.77	M-I	-189 / 48	0.10 (1)
J-K	0 / 35	-91.8	-91.8 0.12 (1)	10.00	B-S	0 / 2022	0.45 (1)
T-B	-2014 / 0	0.0	0.0 0.21 (1)	5.95	M-J	0 / 2022	0.45 (1)
L-J	-2014 / 0	0.0	0.0 0.21 (1)	5.95			
T-S	0 / 0	-18.5	-18.5 0.19 (4)	10.00			
S-R	0 / 1996	-18.5	-18.5 0.42 (1)	10.00			
R-Q	0 / 1996	-18.5	-18.5 0.42 (1)	10.00			
Q-P	0 / 1830	-18.5	-18.5 0.32 (1)	10.00			
P-O	0 / 1830	-18.5	-18.5 0.32 (1)	10.00			
O-N	0 / 1996	-18.5	-18.5 0.42 (1)	10.00			
N-M	0 / 1996	-18.5	-18.5 0.42 (1)	10.00			
M-L	0 / 0	-18.5	-18.5 0.19 (4)	10.00			

TOTAL WEIGHT = 3 X 172 = 516 (M)F

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")

CALCULATED VERT. DEFL.(LL) = L/999 (0.09")

ALLOWABLE DEFL.(TL) = L/360 (1.17")

CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CSI: TC=0.69/1.00 (I-J:1), BC=0.42/1.00 (M-O:1), WB=0.45/1.00 (J-M:1), SS=0.24/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (B) (INPUT = 0.80)


JSI METAL = 0.58 (N) (INPUT = 1.00)



JOB NAME 408087	TRUSS NAME T8	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 AMTek Industries, Inc. Sat Apr 25 08:53:20 2020 Page 1
ID:DMCubINVR6TslFoe31v6f_zns11-QDltzPRCgzhqjU4QsHvTH_yd_WsLl_EBMWxNFezNEqz

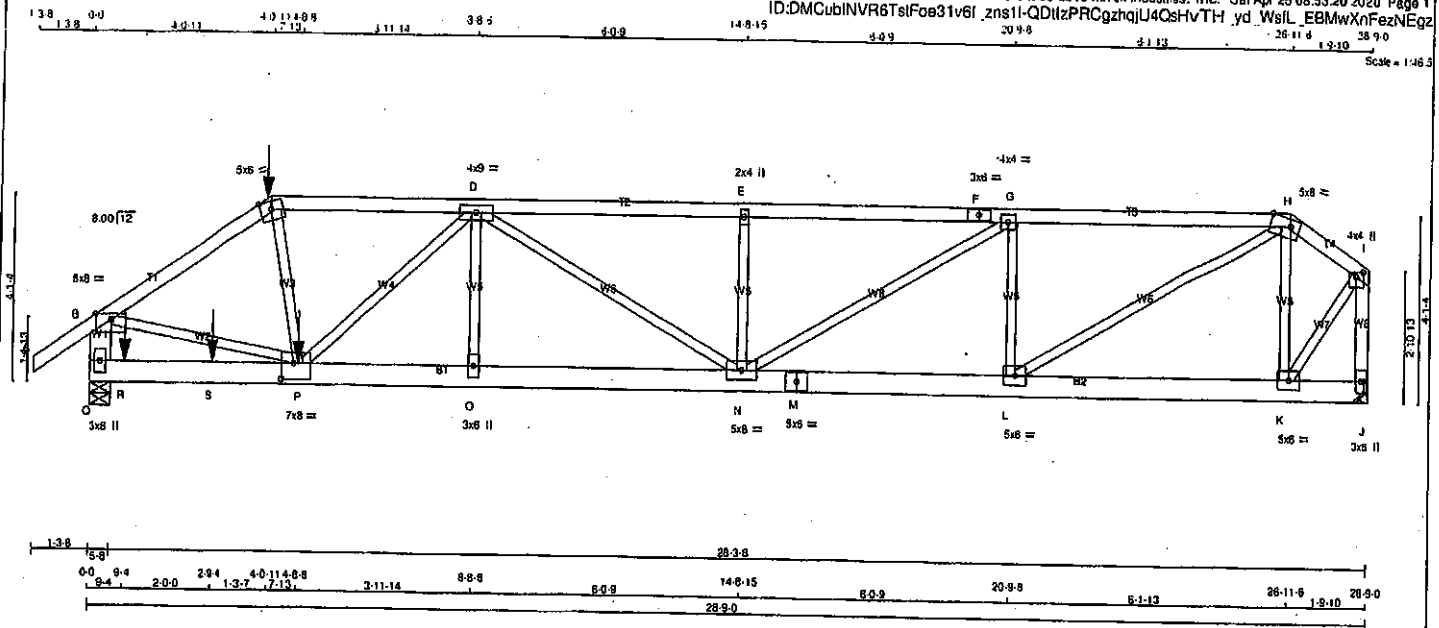

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - F	2x4	DRY No.2	SPF
F - H	2x4	DRY No.2	SPF
H - I	2x4	DRY No.2	SPF
Q - B	2x6	DRY No.2	SPF
J - I	2x4	DRY No.2	SPF
Q - M	2x6	DRY No.2	SPF
M - J	2x6	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE(61.0)
C - F	12	SIDE(61.0)
F - H	12	TOP
H - I	12	TOP
J - I	12	TOP
Q - B	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
Q - M	12	SIDE(183.1)
M - J	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
C - P	4	SIDE(424.8)
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

REACTIONS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	DOWN	UP	IN-SX
Q	3984	0	0	5-8
J	2019	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 4-0.

UNFACTORED REACTIONS

1ST LOSE	MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
Q	2797	1871/0	0/0	0/0	0/0	926/0
J	1426	943/0	0/0	0/0	0/0	483/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.06 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0/35	-91.8 -91.8 0.07 (1)	O-D	0/133
B-C	-4861/0	-91.8 -91.8 0.25 (1)	K-H	-1149/0
C-D	-4441/0	-91.8 -91.8 0.29 (1)	B-P	0/4125
D-E	-4732/0	-91.8 -91.8 0.35 (1)	K-I	0/1843
E-F	-4732/0	-91.8 -91.8 0.43 (1)	C-P	0/2085
F-G	-4732/0	-91.8 -91.8 0.43 (1)	P-O	-744/0
G-H	-3457/0	-91.8 -91.8 0.36 (1)	L-H	0/2910
H-I	-1204/0	-91.8 -91.8 0.03 (1)	D-N	-290/0
Q-B	-3859/0	0.0 0.0 0.14 (1)	L-G	-1411/0
J-I	-2061/0	0.0 0.0 0.18 (1)	N-E	-535/0
Q-R	0/0	-18.5 -18.5 0.06 (1)	N-G	0/1498
R-S	0/0	-18.5 -18.5 0.06 (1)		
S-P	0/0	-18.5 -18.5 0.06 (1)		
P-O	0/4979	-18.5 -18.5 0.37 (1)		
O-N	0/4979	-18.5 -18.5 0.38 (1)		
N-M	0/3457	-18.5 -18.5 0.27 (1)		
M-L	0/3457	-18.5 -18.5 0.27 (1)		
L-K	0/986	-18.5 -18.5 0.10 (1)		
K-J	0/0	-18.5 -18.5 0.04 (1)		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-11	-49	-55	---	FRONT	VERT	DEAD	---
P	4-0-11	-254	-254	---	FRONT	VERT	SNOW	---
R	4-8-8	-2329	-2329	---	FRONT	VERT	TOTAL	---
S	9-4	-29	-29	---	FRONT	VERT	TOTAL	---
S	2-9-4	-26	-26	---	FRONT	VERT	TOTAL	---

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 132 = 264 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.96")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (0.96")
CALCULATED VERT. DEFL.(TL) = L/999 (0.21")

CSI: TC=0.43/1.00 (E-G:1), BC=0.37/1.00 (O-P:1),
WB=0.51/1.00 (B-P:1), SS=0.15/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1667 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (C1) INPUT = 0.90
JSI METAL= 0.47 (P1) INPUT = 1.00

CONTINUED ON PAGE 2



Structural component only
DWG# T-2006980 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408087	T8	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 08:53:20 2020 Page 2
ID:DMCubINVR6TstFos31v6I zns!-QDIlzPRCgzhqIU4QsHvTH yd WsLL EBMwXnFezNEoz

PLATES (table in inches)


JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTW-m	MT20	5.0	6.0	Edge	
D	TMVWW-t	MT20	4.0	9.0		
E	TMV-w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMVWW-t	MT20	4.0	4.0		
H	TTWW-m	MT20	5.0	8.0	Edge	5.50
I	TMVW-p	MT20	4.0	4.0	1.25	2.00
J	BMV1-p	MT20	3.0	6.0		
K	BMVW-t	MT20	5.0	6.0		
L	BMVW-t	MT20	5.0	6.0		
M	BS-t	MT20	5.0	6.0		
N	BMVWW-t	MT20	5.0	6.0		
O	BMV-w	MT20	3.0	6.0		
P	BMVWW-t	MT20	7.0	8.0	4.25	3.25
Q	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2006960 2/2

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 08:53:21 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-uPrgAlSQRghLdFcP_QipCViBwAS4T0LaafIKn4zNEov

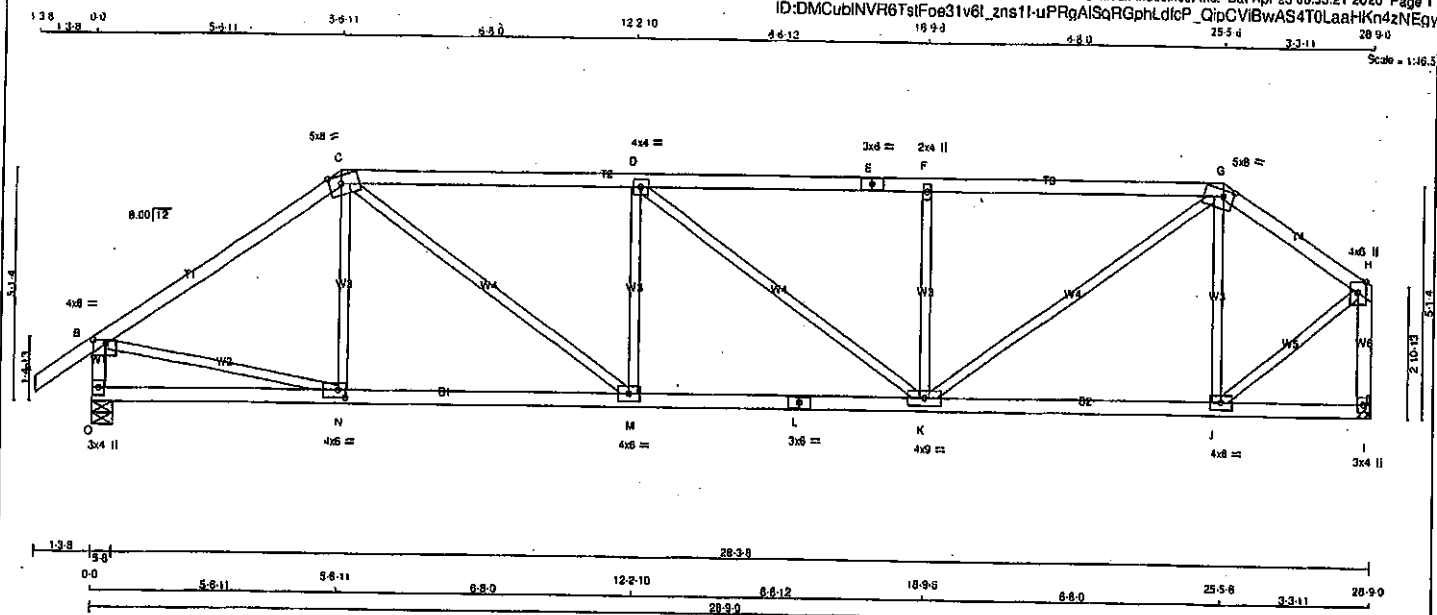

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER	DESCR	
A - C		2x4	DRY	No.2	SPF
C - E		2x4	DRY	No.2	SPF
E - G		2x4	DRY	No.2	SPF
G - H		2x4	DRY	No.2	SPF
O - B		2x4	DRY	No.2	SPF
I - H		2x4	DRY	No.2	SPF
O - L		2x4	DRY	No.2	SPF
L - I		2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY
EXCEPT
DRY: SEASONED LUMBER

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMWV-q	MT20	4.0	8.0	1.00 3.25
C	TMWV-m	MT20	5.0	8.0	2.00 3.25
D	TMWV-l	MT20	4.0	4.0	
E	TS-l	MT20	3.0	8.0	
F	TMW-v	MT20	2.0	4.0	
G	TTWV-m	MT20	5.0	8.0	1.75 2.75
H	TMWV+p	MT20	4.0	8.0	Edge
I	BMV1+p	MT20	3.0	4.0	
J	BMWV-l	MT20	4.0	8.0	
K	BMWV-l	MT20	4.0	3.0	
L	BS-l	MT20	3.0	6.0	
M	BMWV-l	MT20	4.0	8.0	
N	BMWV-l	MT20	4.0	5.0	2.00 2.00
O	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING OFFICIAL

BUILDING DESIGNER		FACTORED		MAXIMUM FACTORED		INPUT	REQD
BEARINGS		GROSS REACTION		GROSS REACTION		BRG	BRG
JO	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
0	1711	0	1711	0	0	5-8	5-8
1	1585	0	1585	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JO	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
	1208	806 / 0	0 / 0	0 / 0	0 / 0	402 / 0	0 / 0
I	1121	736 / 0	0 / 0	0 / 0	0 / 0	385 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBB			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	N-C	-159 / 42	0.06 (1)
B-C	-1804 / 0	-91.8	-91.8 0.83 (1)	4.25	C-M	0 / 1121	0.25 (1)
C-D	-2406 / 0	-91.8	-91.8 0.79 (1)	3.59	M-D	-536 / 0	0.21 (1)
D-E	-2236 / 0	-91.8	-91.8 0.75 (1)	3.73	D-K	-210 / 0	0.29 (1)
E-F	-2236 / 0	-91.8	-91.8 0.75 (1)	3.73	K-F	-680 / 0	0.25 (1)
F-G	-2236 / 0	-91.8	-91.8 0.78 (1)	3.74	K-G	0 / 1548	0.35 (1)
G-H	-1196 / 0	-91.8	-91.8 0.19 (1)	6.82	J-G	-642 / 0	0.25 (1)
D-B	-1870 / 0	0.0	0.0 0.17 (1)	6.42	B-H	0 / 1526	0.34 (1)
I-H	-1570 / 0	0.0	0.0 0.24 (1)	6.58	J-H	0 / 1248	0.28 (1)
O-N	0 / 0	-18.5	-18.5 0.16 (4)	10.00			
N-M	0 / 1498	-18.5	-18.5 0.33 (1)	10.00			
M-L	0 / 2406	-18.5	-18.5 0.48 (1)	10.00			
L-K	0 / 2406	-18.5	-18.5 0.48 (1)	10.00			
K-J	0 / 980	-18.5	-18.5 0.24 (4)	10.00			
J-I	0 / 0	-18.5	-18.5 0.12 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	=	25.6 PSF
	DL	=	8.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.4 PSF
TOTAL LOAD		=	39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF 8CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.96")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL)= L/360 (0.96")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSI: TC=0.79/1.00 (C-D:1) , BC=0.46/1.00 (K-M:1)
WB=0.35/1.00 (G-K:1) , SSI=0.28/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10


COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)
	MAX	MIN	MAX	MIN	MAX
MT20	818	354	1667	788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP = 0.88 (B) (INPUT = 0.90)
JSI METAL = 0.79 (L) (INPUT = 1.00)

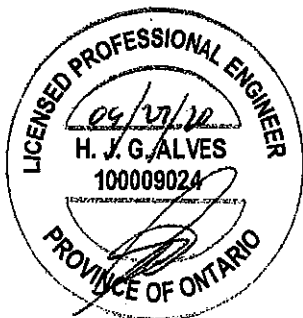


Structural component only
DWG# T-2006961

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408087	T10S	2	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 26 08:53:22 2020 Page 1
ID=DMCubINVR6TstFoe31v6I_zns1I-Mb72OSTSCaxYynEozhxxMP2yaJYspwUpE0uKXzNEgx

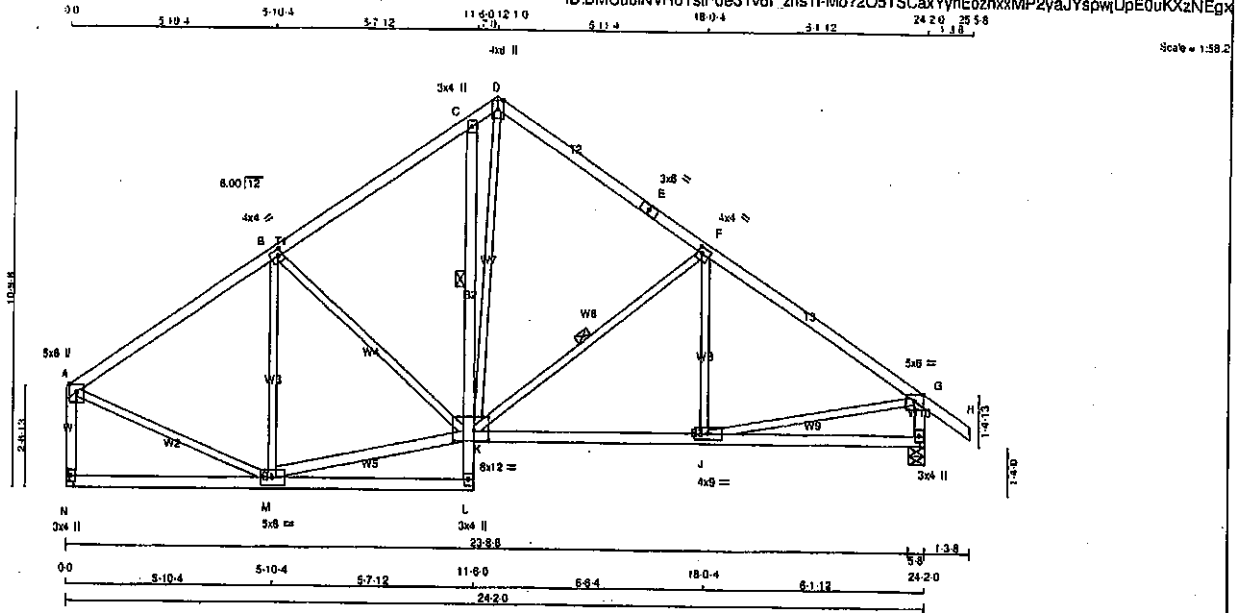

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - H	2x4	DRY	No.2
N - A	2x4	DRY	No.2
I - G	2x4	DRY	No.2
N - L	2x4	DRY	No.2
L - C	2x4	DRY	No.2
K - I	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
M - K	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW+p	MT20	5.0	6.0	Edge
B	TMVW-t	MT20	4.0	4.0	2.00 1.50
C	TMV+p	MT20	3.0	4.0	
D	TTW+p	MT20	4.0	6.0	Edge
E	TS-t	MT20	3.0	6.0	
F	TMVW-t	MT20	4.0	4.0	2.00 1.50
G	TMVW-p	MT20	5.0	6.0	Edge
I	BMV1+p	MT20	3.0	4.0	
J	BMVW-t	MT20	4.0	9.0	
K	BMVWWW-t	MT20	8.0	12.0	3.25 5.00
L	BMV+p	MT20	3.0	4.0	
M	BMVWW-t	MT20	5.0	8.0	
N	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG					
	VERT	HORZ	DOWN	UP/LIFT	IN-SX	IN-SX			
N	1332	0	1332	0	0	MECHANICAL			
I	1458	0	1458	0	0	5-8	5-8		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT N. MINIMUM BEARING LENGTH AT JOINT N = 3-8.

UNFACTORED REACTIONS							
JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
N	942	618 / 0	0 / 0	0 / 0	0 / 0	324 / 0	0 / 0
I	1029	689 / 0	0 / 0	0 / 0	0 / 0	340 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.80 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-K, F-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	-1161 / 0	-91.8 -91.8	0.40 (1)	5.41	M-B	-525 / 0	0.38 (1)
B-C	-1153 / 0	-91.8 -91.8	0.38 (1)	5.46	M-K	0 / 1022	0.16 (1)
C-D	-1180 / 0	-91.8 -91.8	0.10 (1)	5.78	B-K	-90 / 0	0.10 (1)
D-E	-1081 / 0	-91.8 -91.8	0.45 (1)	5.52	K-D	0 / 1053	0.24 (1)
E-F	-1061 / 0	-91.8 -91.8	0.45 (1)	5.52	K-F	-534 / 0	0.26 (1)
F-G	-1494 / 0	-91.8 -91.8	0.49 (1)	4.80	J-F	-80 / 88	0.04 (1)
G-H	0 / 35	-91.8 -91.8	0.12 (1)	10.00	A-M	0 / 1077	0.24 (1)
N-A	-1291 / 0	0.0 0.0	0.19 (1)	7.10	J-G	0 / 1293	0.29 (1)
I-G	-1415 / 0	0.0 0.0	0.15 (1)	6.85			
N-M	0 / 0	-18.5 -18.5	0.17 (4)	10.00			
M-L	0 / 10	-18.5 -18.5	0.17 (4)	10.00			
L-K	0 / 44	0.0 0.0	0.02 (1)	10.00			
K-C	-337 / 0	0.0 0.0	0.03 (1)	8.25			
K-J	0 / 1273	-18.5 -18.5	0.32 (4)	10.00			
J-I	0 / 0	-18.5 -18.5	0.21 (4)	10.00			

TOTAL WEIGHT = 2 X 122 = 244 lb

(M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
OL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.81")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CSI: TC=0.48/1.00 (F-G:1), BC=0.32/1.00 (J-K:4), WB=0.38/1.00 (B-M:1), SSI=0.23/1.00 (F-G:1)

DOL LUMBER: 1.00 NAIL=1.00 LS BENO=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

ISI GRIP = 0.82 (G) (INPUT = 0.90)

ISI METAL = 0.48 (A) (INPUT = 1.00)

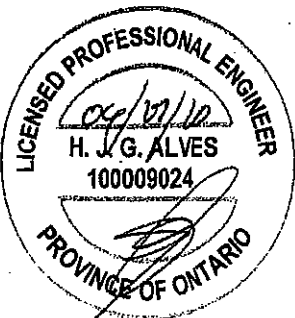


Structural component only
DWG# T-2006962

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408087	T11	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 08:53:22 2020 Page 1
ID:DMCubINVR6TslFae31v6l_zns1l-Mb?2O5TSCaxYynEozhxxMP2z9Jb7p_NUpE0uKXzNEgx

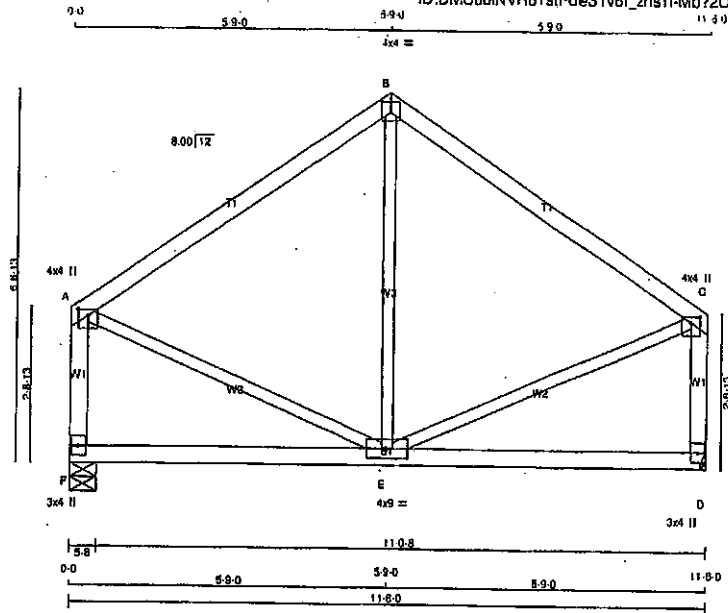

Scale = 1:127.4

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - B	2x4	DRY	No.2	
B - C	2x4	DRY	No.2	
F - A	2x4	DRY	No.2	
D - C	2x4	DRY	No.2	
F - D	2x4	DRY	No.2	

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TTW-p	MT20	4.0	4.0	2.25	2.00
C	TMVW+p	MT20	4.0	4.0	1.25	2.00
D	BMV1+p	MT20	3.0	4.0		
E	BMVWW-t	MT20	4.0	9.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
F	634 0	634 0	5-8	5-8
D	634 0	634 0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	448	294 / 0	0 / 0	0 / 0	0 / 0	0 / 0	154 / 0	0 / 0
D	448	294 / 0	0 / 0	0 / 0	0 / 0	0 / 0	154 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED LC1 MAX (LBS)	MAX. UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED CSI (LC)
FR-TO		FROM	TO		FR-TO		
A-B	-365 / 0	-91.8	-91.8	0.39 (1)	E-B	-123 / 54	0.09 (1)
B-C	-365 / 0	-91.8	-91.8	0.39 (1)	A-E	0 / 329	0.07 (1)
F-A	-593 / 0	0.0	0.0	0.09 (1)	E-C	0 / 329	0.07 (1)
D-C	-593 / 0	0.0	0.0	0.09 (1)			
F-E	0 / 0	-18.5	-18.5	0.16 (4)			
E-D	0 / 0	-18.5	-18.5	0.16 (4)			

TOTAL WEIGHT = 2 X 49 = 98 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	8.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.38")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.38")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.39/1.00 (A-B:1), BC=0.18/1.00 (D-E:4), WB=0.09/1.00 (B-E:1), SS=0.17/1.00 (A-B:1)

DOL LUMBER-1.00 NAIL-1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1887
	788	1887	1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.41 (C) (INPUT = 0.90)
JSI METAL = 0.12 (A) (INPUT = 1.00)




Structural component only
DWG# T-2006963

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408087	T11S	3	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 08:53:23 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1f-qoYQbRU5zu3Pxp?XPSAudaD2ju1YR6e2tmRszNEgw

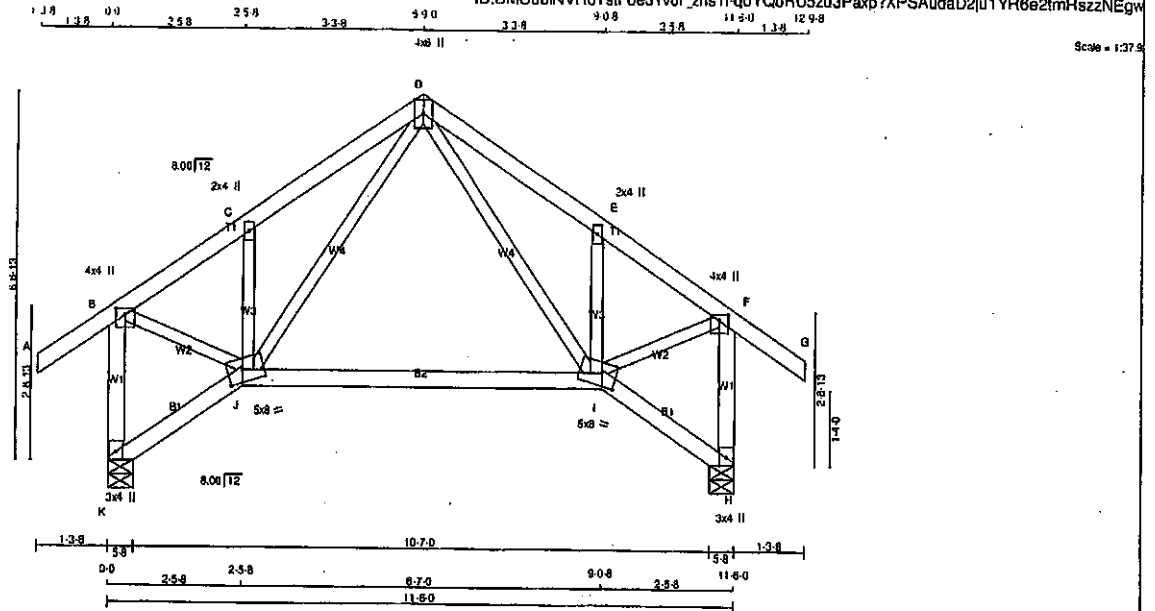

LUMBER						
N. L. G. A. RULES						
CHORDS		SIZE	LUMBER		DESCR.	
K - B		2x4	DRY	No.2	SPF	
A - D		2x4	DRY	No.2	SPF	
D - G		2x4	DRY	No.2	SPF	
H - F		2x4	DRY	No.2	SPF	
K - J		2x4	DRY	No.2	SPF	
J - I		2x4	DRY	No.2	SPF	
I - H		2x4	DRY	No.2	SPF	
ALL WEBS			2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.						

PLATES (Table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00	
C	TMVW+w	MT20	2.0	4.0			
D	TTWW+p	MT20	4.0	6.0	Edge		
E	TMVW+w	MT20	2.0	4.0			
F	TMVW+p	MT20	4.0	4.0	1.25	2.00	
H	BMV1+p	MT20	3.0	4.0	Edge		
I	BBWWW-m	MT20	5.0	8.0	2.75	3.25	
J	BBWWW-m	MT20	5.0	8.0	2.75	3.25	
K	BMV1+p	MT20	3.0	4.0	Edge		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	GROSS REACTION	BRG	BRG
K	VERT	HORZ	DOWN	HORZ	UPLIFT
K	760	0	760	0	5-8
H	760	0	760	0	5-8

UNFACTORED REACTIONS		1ST LCASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
K	535	384/0	0/0
H	535	384/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED	MEMB.	MAX. FACTORED
FR-TO	FORCE (LBS)	FR-TO	FORCE (LBS)
K-B	-737/0	D-I	0/241
A-B	0/35	I-E	-328/0
B-C	-582/0	I-F	0/527
C-D	-599/0	J-D	0/241
D-E	-599/0	J-C	-328/0
E-F	-582/0	B-J	0/527
F-G	0/35		
H-F	-737/0		
K-J	0/0		
J-I	0/352		
I-H	0/0		

TOTAL WEIGHT = 3 X 57 = 170 lb

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.38")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.38")
CALCULATED VERT. DEFL.(TL) = L/999 (0.10")

CSI: TC=0.12/1.00 (A-B:1), BC=0.26/1.00 (I-J:4),
WB=0.12/1.00 (B-J:1), SS=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES	
PLATE GRIP(DRY)	SHEAR SECTION
(PSI)	(PLI)
MAX MIN	MAX MIN
MT20	616 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.54 (F) (INPUT = 0.30)

JSI METAL = 0.24 (K) (INPUT = 1.00)

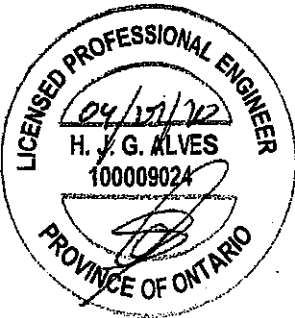


Structural component only
DWG# T-2008964

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408087	T12	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 08:53:24 2020 Page 1
ID:DMCubNVR6TstFoe31v6l_zns1H_6oonUjkBBQC5OB56zPrq7EX79FHIZnGXV_OPzNEqV

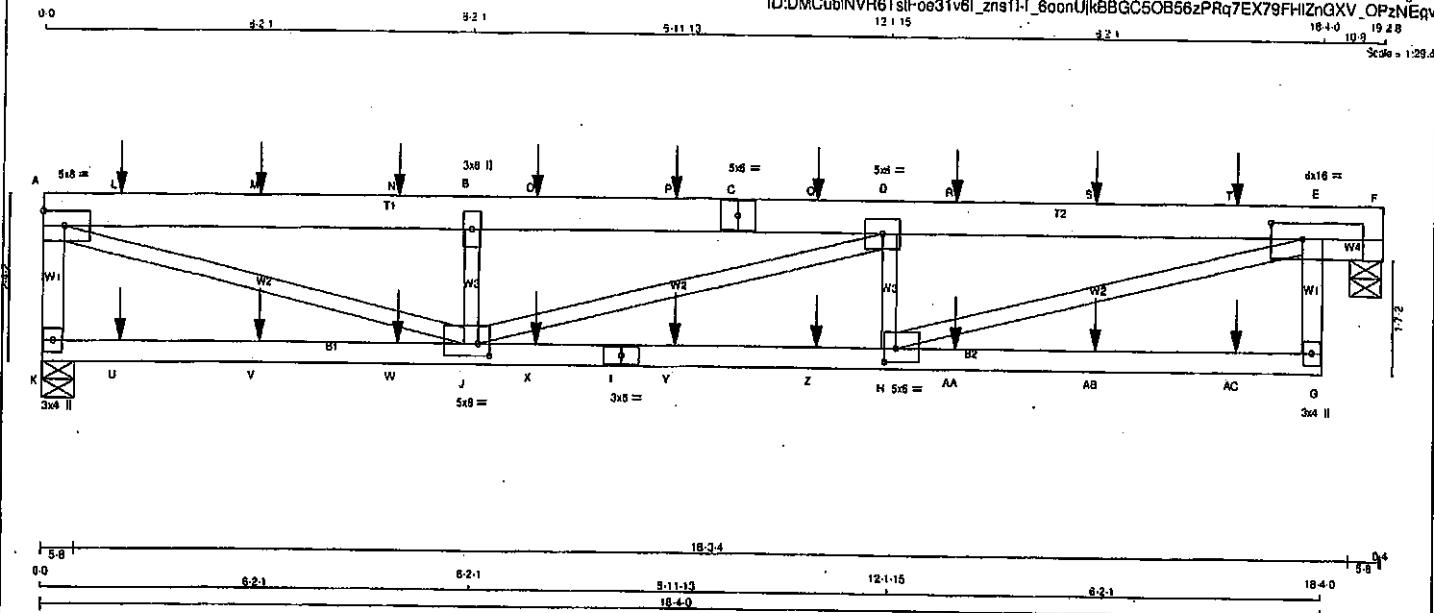

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
K - A	2x4	DRY	No.2	SPF	
A - C	2x6	DRY	No.2	SPF	
C - F	2x6	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
G - E	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
I - G	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY
DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122'X3") SPIRAL NAILS		
K - A	12	TOP
E - G	12	TOP
A - C	12	SIDE(0.0)
C - F	12	SIDE(0.0)
BOTTOM CHORDS : (0.122'X3") SPIRAL NAILS		
K - I	12	SIDE(0.0)
I - G	12	SIDE(0.0)
WEBS : (0.122'X3") SPIRAL NAILS		
2x3	6	
2x4	1	6

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
K	2110	0	2110	0
F	1995	0	1995	0

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): F

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED
K	1492
F	1410

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.04 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (PLF)	MEMB.	FORCE (LBS)
FR-TO				FR-TO	
K-A	-1971 / 0	0.0	0.0	H-E	0 / 5502
A-L	-4759 / 0	-91.8	-91.8	A-J	0 / 4995
L-M	-4759 / 0	-91.8	-91.8	H-D	-1322 / 0
M-N	-4759 / 0	-91.8	-91.8	J-B	-995 / 0
N-B	-4759 / 0	-91.8	-91.8	J-D	-508 / 0
B-O	-4759 / 0	-91.8	-91.8		
O-P	-4759 / 0	-91.8	-91.8		
P-C	-4759 / 0	-91.8	-91.8		
C-Q	-4759 / 0	-91.8	-91.8		
Q-D	-4759 / 0	-91.8	-91.8		
D-R	-5242 / 0	-91.8	-91.8		
R-S	-5242 / 0	-91.8	-91.8		
S-T	-5242 / 0	-91.8	-91.8		
T-E	-5242 / 0	-91.8	-91.8		
E-F	-788 / 0	-91.8	-91.8		
G-E	0 / 140	0.0	0.0		

K-U	0/0	-18.5	-18.5	0.18 (4)	10.00
U-V	0/0	-18.5	-18.5	0.16 (4)	10.00
V-W	0/0	-18.5	-18.5	0.18 (4)	10.00
W-J	0/0	-18.5	-18.5	0.18 (4)	10.00
J-X	0/ 5242	-18.5	-18.5	0.58 (1)	10.00
X-I	0/ 5242	-18.5	-18.5	0.58 (1)	10.00
I-Y	0/ 5242	-18.5	-18.5	0.58 (1)	10.00
Y-Z	0/ 5242	-18.5	-18.5	0.58 (1)	10.00
Z-H	0/ 5242	-18.5	-18.5	0.58 (1)	10.00
H-AA	0-0	-18.5	-18.5	0.16 (4)	10.00
AA-AB	0-0	-18.5	-18.5	0.16 (4)	10.00
AB-AC	0-0	-18.5	-18.5	0.16 (4)	10.00
AC-G	0-0	-18.5	-18.5	0.16 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2015, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.61")
CALCULATED VERT. DEFL.(LL) = U/999 (0.17")
ALLOWABLE DEFL.(TL) = L/360 (0.61")
CALCULATED VERT. DEFL.(TL) = U/704 (0.31")

CSI: TC=0.72/1.00 (D-E:1), BC=0.58/1.00 (H-J:1),

WB=0.89/1.00 (E-H:1), SS=0.37/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (H) (INPUT = 0.90)

JSI METAL= 0.85 (I) (INPUT = 1.00)

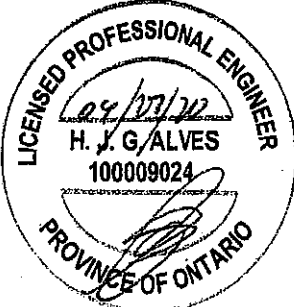

Structural component only
DWG# T-2006965 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408087	T12	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 08:53:24 2020 Page 2
ID:DMCubINVR6TslFoe31v6I zns1H 8oonUikBBGC5OB56zPRq7EX9FHIZnQXV OPzNEgv

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWW-I	MT20	5.0	8.0		Edge
B	TMWW-w	MT20	3.0	8.0		
C	TS-I	MT20	5.0	8.0		
D	TMWW-I	MT20	5.0	8.0		
E	TMWW-I	MT20	8.0	16.0	2.75	5.50
G	BMV+p	MT20	3.0	4.0		
H	BMWW-I	MT20	5.0	8.0	2.25	2.00
I	BS-I	MT20	3.0	8.0		
J	BMWW-I	MT20	5.0	8.0	2.00	2.00
K	BMV1+p	MT20	3.0	4.0		


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
S	15-1-7	-151	-151	---	BACK	VERT	TOTAL	---	C1
T	17-1-7	-151	-151	---	BACK	VERT	TOTAL	---	C1
U	1-1-7	-72	-72	---	BACK	VERT	TOTAL	---	C1
V	3-1-7	-72	-72	---	BACK	VERT	TOTAL	---	C1
W	5-1-7	-72	-72	---	BACK	VERT	TOTAL	---	C1
X	7-1-7	-72	-72	---	BACK	VERT	TOTAL	---	C1
Y	9-1-7	-72	-72	---	BACK	VERT	TOTAL	---	C1
Z	11-1-7	-72	-72	---	BACK	VERT	TOTAL	---	C1
AA	13-1-7	-72	-72	---	BACK	VERT	TOTAL	---	C1
AB	15-1-7	-72	-72	---	BACK	VERT	TOTAL	---	C1
AC	17-1-7	-72	-72	---	BACK	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

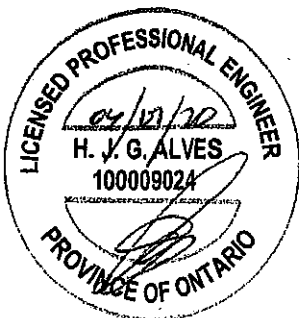

Structural component only
DWG# T-2006965 3/2

JOB NAME 408087	TRUSS NAME T13	QUANTITY 3	PLV 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 \$ Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 08:53:24 2020 Page 1 ID:DMCubINVR6TstFoe31v6I.zns11-4 8oonUjk8BGC50B56zPRq7K57CEHvOnGXV_OPzNEgv		
Scale = 1/2" = 1'-0"						

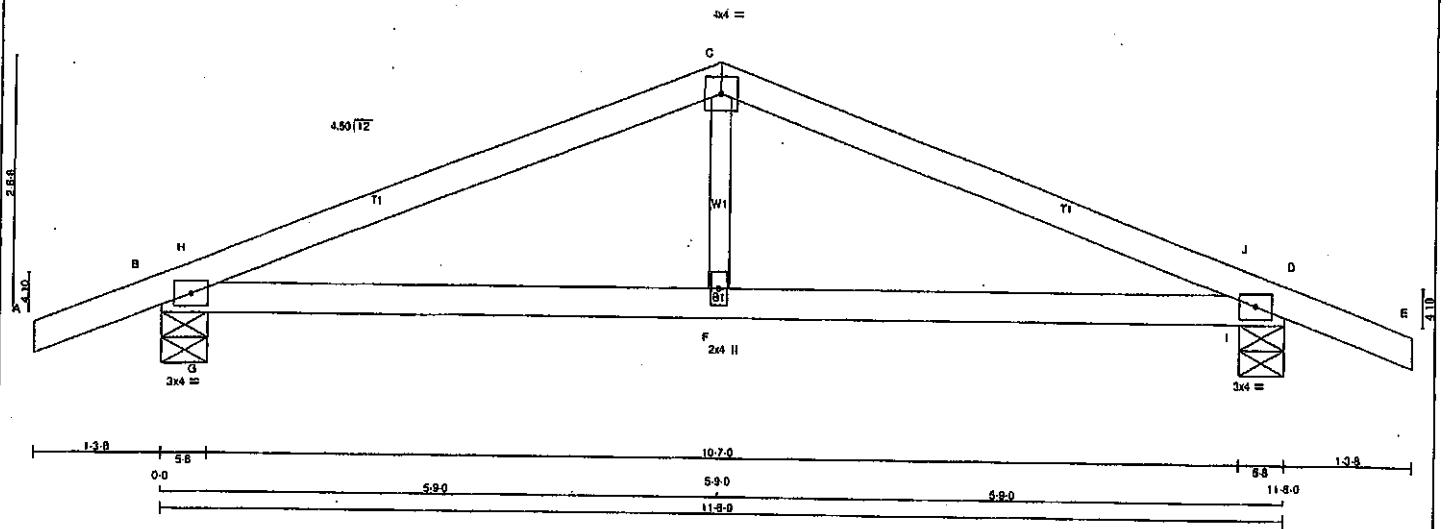

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
B - D	2x4	DRY	No.2

ALL WEBS 2x3 DRY
DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0		
C	TTW-p	MT20	4.0	4.0		
D	TMB1-I	MT20	3.0	4.0		
F	BMW+w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
B	757	0	757	0	5-8	5-8
D	757	0	757	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE		MAX/MIN COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
B	533	383 / 0	0 / 0	0 / 0	0 / 0	170 / 0	0 / 0
D	533	383 / 0	0 / 0	0 / 0	0 / 0	170 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.89 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 / 18	-91.8	-91.8	0.12 (1)	10.00	F-C	0 / 228 0.05 (4)
B-H	-858 / 0	-91.8	-91.8	0.15 (1)	8.25	G-H	-435 / 0 0.00 (1)
H-C	-952 / 0	-91.8	-91.8	0.38 (1)	5.89	I-J	-435 / 0 0.00 (1)
C-J	-952 / 0	-91.8	-91.8	0.38 (1)	5.89		
J-D	-858 / 0	-91.8	-91.8	0.15 (1)	8.25		
D-E	0 / 18	-91.8	-91.8	0.12 (1)	10.00		
B-G	0 / 883	-18.5	-18.5	0.39 (1)	10.00		
G-F	0 / 883	-18.5	-18.5	0.39 (1)	10.00		
F-I	0 / 883	-18.5	-18.5	0.39 (1)	10.00		
I-D	0 / 883	-18.5	-18.5	0.39 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.38")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL) = L/380 (0.38")
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CS1: TC=0.38/1.00 (C-H:1), BC=0.39/1.00 (B-G:1), WB=0.05/1.00 (C-F:4), SS=0.33/1.00 (D-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	518 354	1667 788 1967 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.71 (D) (INPUT = 0.80)
JSI METAL= 0.34 (D) (INPUT = 1.00)




Structural component only
DWG# T-2006966

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408087	G13	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29, 2019 Mitek Industries, Inc. Sat Apr 25 08:53:10 2020 Page 1
ID:DMCubINVR6Ts(Foe31v6I_zns1I-IGWs7KxtuQFWxJVGAI7uY_EUVY?aij2M8FwDzNEh7

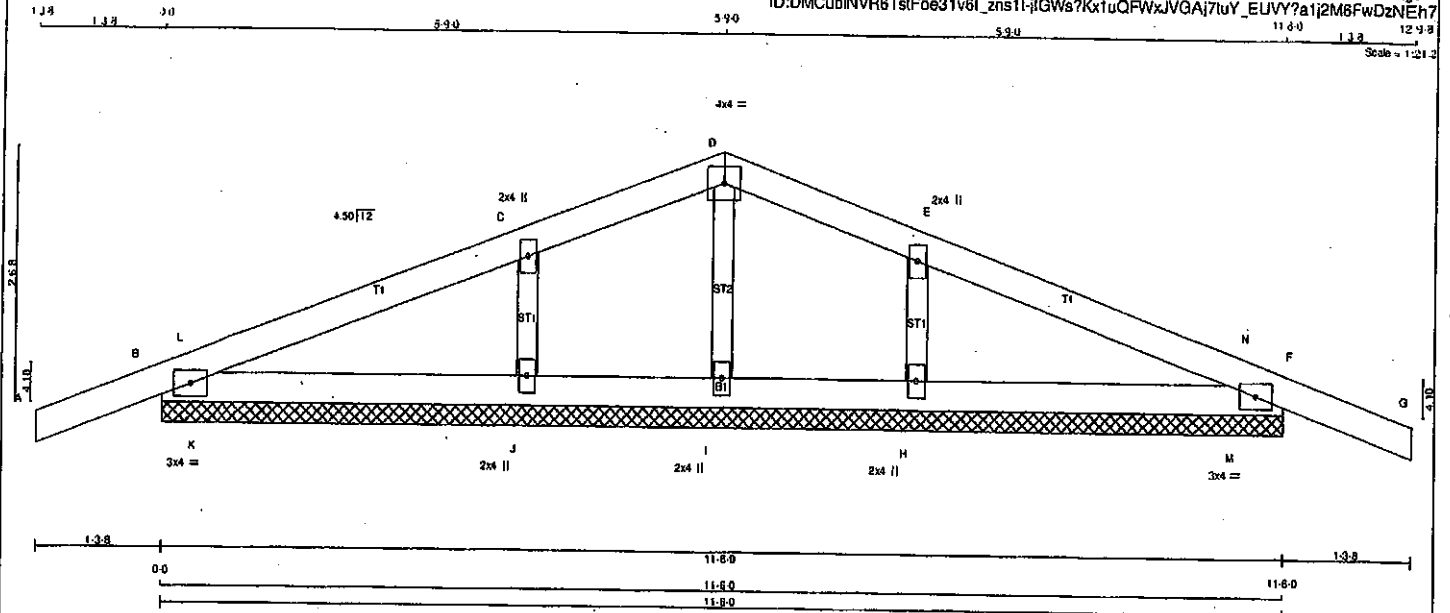

TOTAL WEIGHT = 34 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	2x4	DRY	SPF
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
B - F	2x4	DRY	No.2
ALL WEBS	2x8	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			SPF

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-4	MT20	3.0	4.0		
C	TMW+vw	MT20	2.0	4.0		
D	TTW-p	MT20	4.0	4.0		
E	TMW+vw	MT20	2.0	4.0		
F	TMB1-4	MT20	3.0	4.0		
H, I, J						
H	BMW1+vw	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO		LENGTH	FR-TO			
A-B	0/18	-91.8	-91.8	0.12 (1)	10.00	I-D	-47/3	0.01 (1)
B-L	-80/0	-91.8	-91.8	0.02 (4)	8.25	J-C	-314/0	0.05 (1)
L-C	-71/0	-91.8	-91.8	0.13 (1)	8.25	H-E	-314/0	0.05 (1)
C-D	-85/0	-91.8	-91.8	0.13 (1)	8.25	K-L	-142/8	0.00 (1)
D-E	-85/0	-91.8	-91.8	0.13 (1)	8.25	M-N	-142/8	0.00 (1)
E-N	-71/0	-91.8	-91.8	0.13 (1)	8.25			
N-F	-80/0	-91.8	-91.8	0.02 (4)	8.25			
F-G	0/18	-91.8	-91.8	0.12 (1)	10.00			
B-K	0/75	-18.5	-18.5	0.10 (1)	10.00			
K-J	0/75	-18.5	-18.5	0.10 (1)	10.00			
J-I	0/64	-18.5	-18.5	0.07 (1)	10.00			
I-H	0/64	-18.5	-18.5	0.07 (1)	10.00			
H-M	0/75	-18.5	-18.5	0.10 (1)	10.00			
M-F	0/75	-18.5	-18.5	0.10 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (E-N:1), BC=0.10/1.00 (H-M:1), WB=0.05/1.00 (E-H:1), SSI=0.13/1.00 (E-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRP (DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788	1907 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRP= 0.22 (B) (INPUT = 0.90)

JSI METAL= 0.10 (C) (INPUT = 1.00)

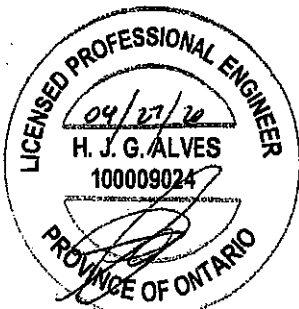


Structural component only
DWG# T-2006948

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRAWING NO.
408087	T14	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 08:53:25 2020 Page 1
ID:DMCubINVR6TstF0e31v6I_zns1I-nAgB07VLVVJ7pFyNeqUe_2gPFXU0FZwVBFYwszNEgu

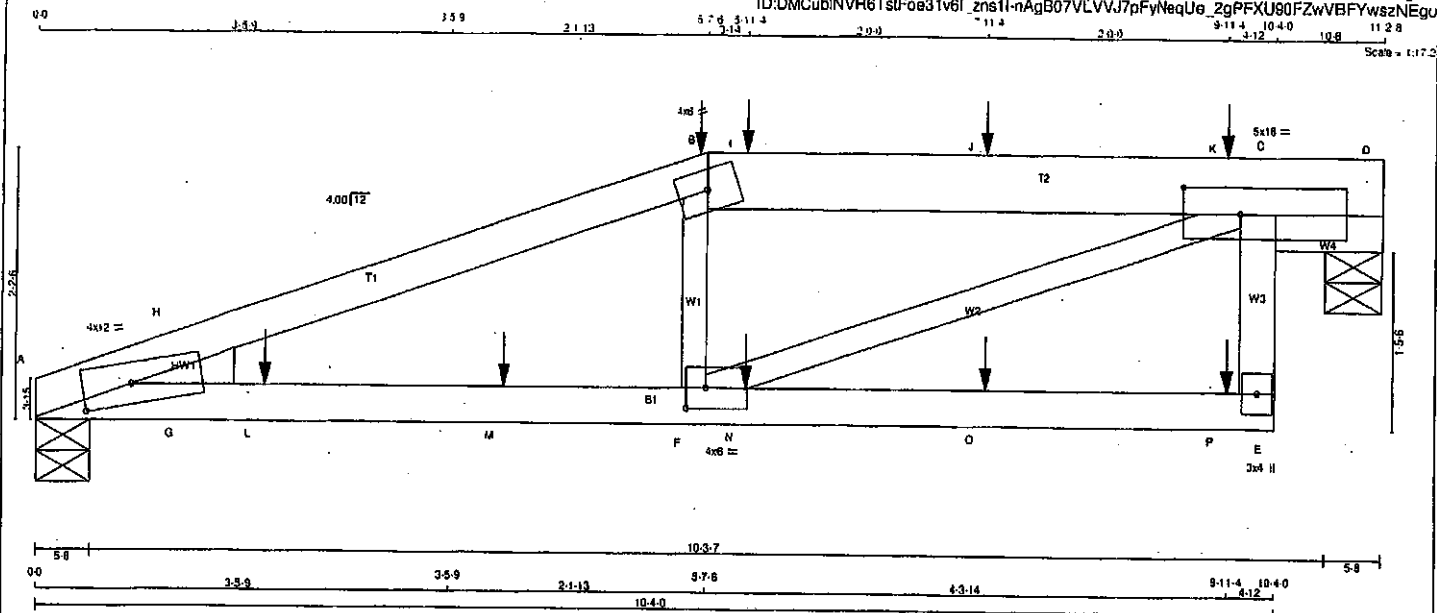

LUMBER				N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.	CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2	A - B	2x4	DRY	No.2
B - D	2x6	DRY	No.2	B - D	2x6	DRY	No.2
C - D	2x4	DRY	No.2	C - D	2x4	DRY	No.2
E - C	2x4	DRY	No.2	E - C	2x4	DRY	No.2
A - E	2x4	DRY	No.2	A - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2	ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.				DRY: SEASONED LUMBER.			

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
A	TMBH1-m	MT20	4.0	12.0	2.00	5.00
B	TTW-h	MT20	4.0	8.0		
C	TMBVW-t	MT20	5.0	16.0	2.50	5.50
E	BMV-p	MT20	3.0	4.0		
F	BMVW-t	MT20	4.0	6.0	2.00	2.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD		HEEL	
JT	VERT	HORZ	GROSS REACTION	GROSS REACTION	BRG	BRG	HEEL	WEDGE	WEDGE	WEDGE	WEDGE
D	1050	0	1050	0	0	5-8	5-8	5-8	5-8	2x4 L	
A	953	0	953	0	0	5-8	5-8	5-8	5-8	2x4 L	

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): D

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	739	506 / 0	0 / 0	0 / 0	0 / 0	233 / 0	0 / 0	0 / 0
A	672	453 / 0	0 / 0	0 / 0	0 / 0	219 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D, A

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.24 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. (LBS)	MAX. (LBS)	MEMB.	FORCE (LBS)	MAX. (LBS)	MAX. (LBS)	MAX. (LBS)
FR-TO		FROM	TO	LENGTH	FR-TO				
A-H	-2013 / 0	-91.8	-91.8	0.13 (1)	4.83	F-B	-409 / 0	0.07 (1)	
H-B	-1976 / 0	-91.8	-91.8	0.45 (1)	4.24	F-C	0 / 2038	0.50 (1)	
B-I	-1905 / 0	-91.8	-91.8	0.72 (1)	4.53	G-H	-146 / 10	0.00 (1)	
I-J	-1905 / 0	-91.8	-91.8	0.72 (1)	4.53				
J-K	-1905 / 0	-91.8	-91.8	0.72 (1)	4.53				
K-L	-1905 / 0	-91.8	-91.8	0.72 (1)	4.53				
C-D	0 / 0	-91.8	-91.8	0.40 (1)	10.00				
E-C	0 / 95	0.0	0.0	0.02 (4)	10.00				
A-G	0 / 1883	-18.5	-18.5	0.88 (1)	10.00				
G-L	0 / 1883	-18.5	-18.5	0.87 (1)	10.00				
L-M	0 / 1883	-18.5	-18.5	0.87 (1)	10.00				
M-F	0 / 1883	-18.5	-18.5	0.87 (1)	10.00				
F-N	0 / 0	-18.5	-18.5	0.22 (1)	10.00				
N-O	0 / 0	-18.5	-18.5	0.22 (1)	10.00				
O-P	0 / 0	-18.5	-18.5	0.22 (1)	10.00				
P-E	0 / 0	-18.5	-18.5	0.22 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
B	5-7-6	-45	-50	---	FRONT	VERT	DEAD	C1
B	5-7-6	-237	-237	---	FRONT	VERT	SNOW	C1
I	5-11-4	-103	-103	---	BACK	VERT	TOTAL	C1
J	7-11-4	-72	-72	---	BACK	VERT	TOTAL	C1
K	9-11-4	-72	-72	---	BACK	VERT	TOTAL	C1
L	1-11-4	-50	-50	---	BACK	VERT	TOTAL	C1
M	3-11-4	-50	-50	---	BACK	VERT	TOTAL	C1
N	5-11-4	-50	-50	---	BACK	VERT	TOTAL	C1
O	7-11-4	-50	-50	---	BACK	VERT	TOTAL	C1
P	9-11-4	-55	-55	---	BACK	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF 808C 2018, OBC 2012, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.34")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.10")
ALLOWABLE DEFL. (TL) = $L/360$ (0.34")
CALCULATED VERT. DEFL. (TL) = $L/677$ (0.18")

CSI: TC=0.72/1.00 (B-C:1), BC=0.67/1.00 (P-Q:1),
WB=0.50/1.00 (C-F:1), SS=0.43/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.86 (F) (INPUT = 0.90)
JSI METAL = 0.47 (F) (INPUT = 1.00)




Structural component only
DWG# T-2006987

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408087	T15	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 08:53:26 2020 Page 1
ID:DMCubINVR6TsIFoe31v6l zns11-FNEZDTWzGpR_RPXaCX0WFCZoxsllfc4kr_5T1zNEgl

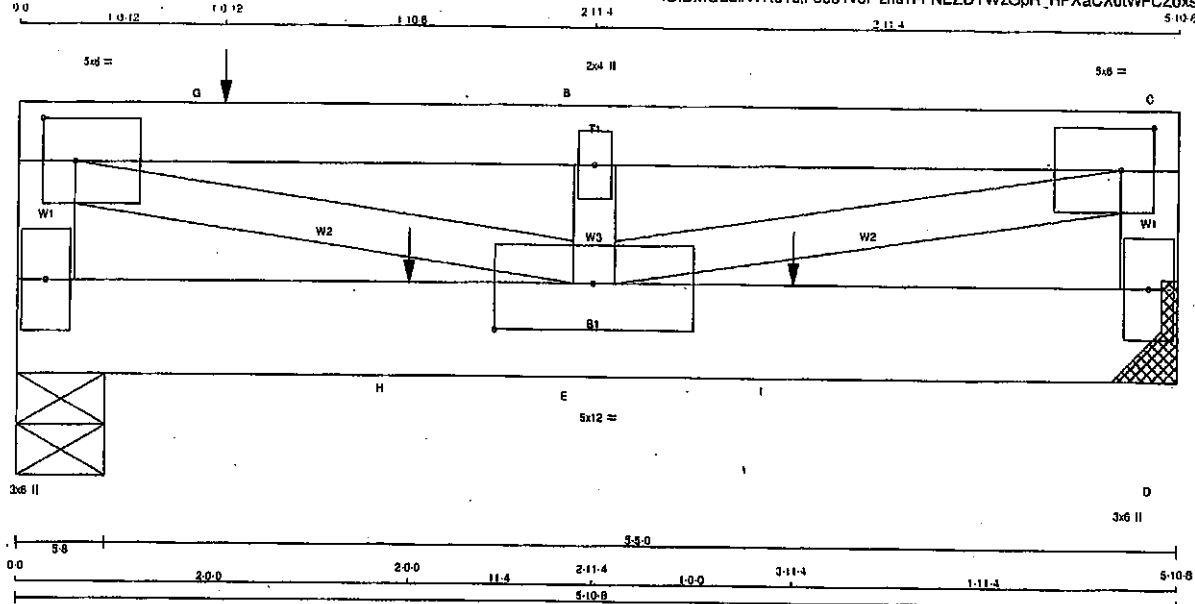

Scale = 1/16"

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS: (0.122'X3') SPIRAL NAILS		
F-A	12	TOP
A-C	12	SIDE(0.0)
C-D	12	TOP
BOTTOM CHORDS: (0.122'X3') SPIRAL NAILS		
F-D	12	SIDE(14.0)
WEBS: (0.122'X3') SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	5.0	6.0	2.50	2.00
B	TMVW-t	MT20	2.0	4.0		
C	TMVW-t	MT20	5.0	6.0	2.50	2.00
D	BMV1-p	MT20	3.0	6.0		
E	BMVWW-t	MT20	5.0	12.0	2.75	6.00
F	BMV1-p	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	VERT	HORZ	BRG	BRG
F	3277	0	3277	0	0
D	2358	0	2358	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4'-0".

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	2323	1495 / 0	0 / 0	0 / 0	0 / 0	888 / 0	0 / 0
D	1673	1070 / 0	0 / 0	0 / 0	0 / 0	602 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.00 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED			MEMB.	MAX. FACTORED	
	FORCE	VERT. LOAD	MAX	MAX.		FORCE	MAX
	(LBS)	(PLF)	CSI (LC)	UNBRAC		(LBS)	CSI (LC)
FR-TO		FROM	TO	LENGTH	FR-TO		
F-A	-2531 / 0	0.0	0.0	0.14 (1)	7.12	A-E	0 / 5214
A-G	-4958 / 0	-91.8	-91.8	0.80 (1)	3.00	E-B	-799 / 0
G-B	-4958 / 0	-91.8	-91.8	0.80 (1)	3.00	E-C	0 / 5214
B-C	-4958 / 0	-91.8	-91.8	0.18 (1)	4.22		0.65 (1)
D-C	-1717 / 0	0.0	0.0	0.09 (1)	7.61		0.06 (1)
F-H	0 / 0	-43.5	-43.5	0.52 (1)	10.00		
H-E	0 / 0	-43.5	-43.5	0.52 (1)	10.00		
E-I	0 / 0	-43.5	-43.5	0.43 (1)	10.00		
I-D	0 / 0	-43.5	-43.5	0.43 (1)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LG1	MAX	FACE	DIR.	TYPE	HEEL	CONN.
G	1-0-12	-1275	-1275	---	BACK	VERT	TOTAL	---
H	2-0-0	-2000	-2000	---	BACK	VERT	TOTAL	---
I	3-11-4	-1568	-1568	---	BACK	VERT	TOTAL	---

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 23 = 47 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
DL	=	6.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/822 (0.08")

CSI: TC=0.80/1.00 (A-B:1), BC=0.52/1.00 (E-F:1), WB=0.65/1.00 (A-E:1), SS=0.46/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1667
		788	1987
		1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.87 (A), INPUT = 0.90
JSI METAL = 0.62 (C), INPUT = 1.00



Structural component only
DWG# T-2006968

JOB NAME 408088	TRUSS NAME T20	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 09:03:31 2020 Page 1
 ID:DMCubINVR6TsiFoe31v6f_zns1l-1mHCKrTnhf8WNHr85MIXrm_bpOu?Mu7st2cKzNEXQ

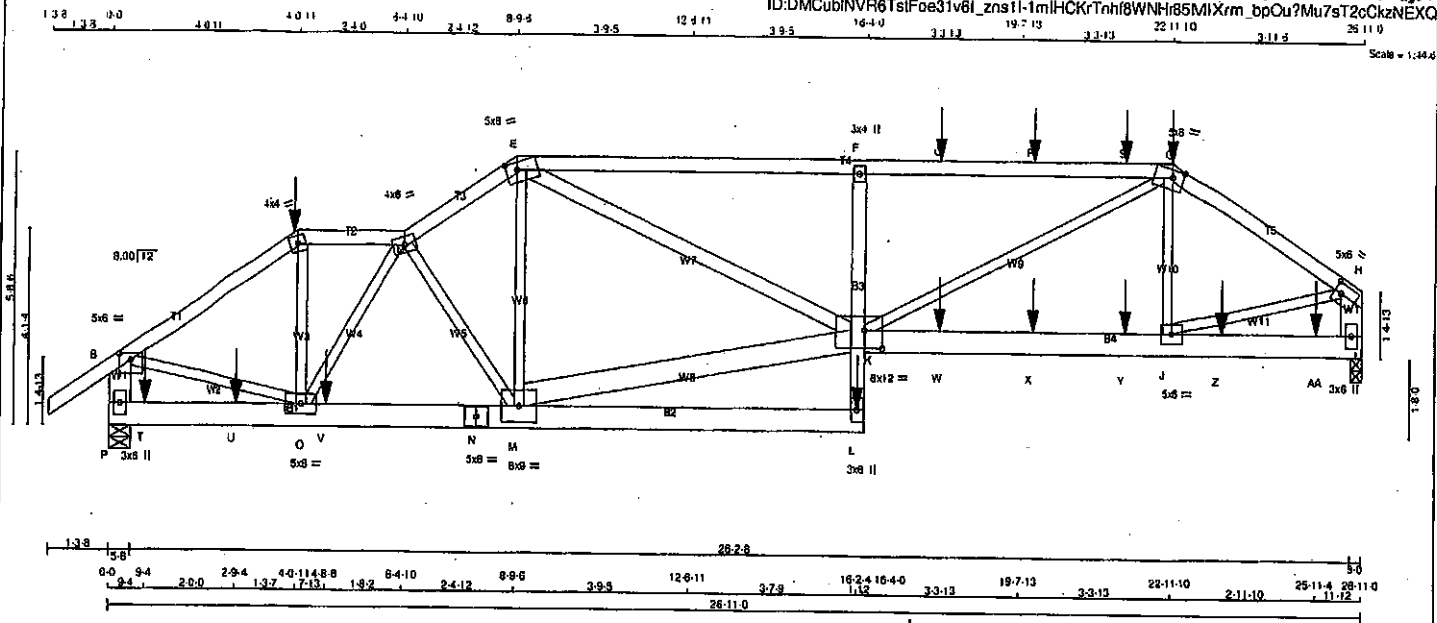

LUMBER
N. L. G. A. RULES


CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - H	2x4	DRY	No.2	SPF
P - B	2x6	DRY	No.2	SPF
I - H	2x6	DRY	No.2	SPF
P - N	2x6	DRY	No.2	SPF
N - L	2x6	DRY	No.2	SPF
L - F	2x4	DRY	No.2	SPF
K - I	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
 EXCEPT
 M - K 2x6 DRY No.2 SPF
 E - K 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER.
 DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE(81.0)
C - D	12	SIDE(81.0)
D - E	12	TOP
E - G	12	SIDE(81.0)
G - H	12	SIDE(81.0)
P - B	12	TOP
I - H	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
P - N	12	SIDE(0.0)
N - L	12	SIDE(122.0)
K - I	12	SIDE(0.0)
L - F	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	
2x4	8	
2x6	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.
 GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

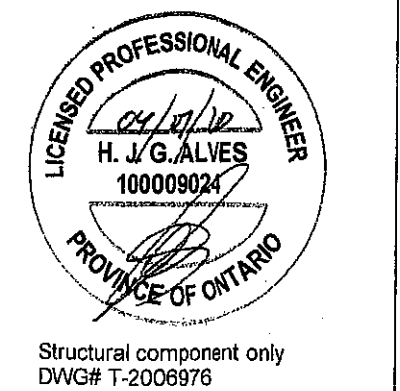

Structural component only
 DWG# T-2006976

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
	GROSS REACTION	GROSS REACTION	DOWN	UP	BRG	BRG	IN-SX	IN-SX
JT	2911	0	2911	0	5-8	5-8		
P	2155	0	2155	0	3-0	3-0		

UNFACTORED REACTIONS	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
JT	2052	1382 / 0	0 / 0	0 / 0	0 / 0	670 / 0	0 / 0
P	1522	1014 / 0	0 / 0	0 / 0	0 / 0	508 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.92 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8	-91.8 0.07 (1)	10.00	O-C	0 / 1291 0.16 (1)	
B-C	-3385 / 0	-91.8	-91.8 0.20 (1)	4.80	D-M	-1271 / 0 0.21 (1)	
C-D	-2889 / 0	-91.8	-91.8 0.07 (1)	5.38	M-E	0 / 680 0.09 (1)	
D-E	-3303 / 0	-91.8	-91.8 0.09 (1)	5.07	M-K	0 / 2773 0.18 (1)	
E-F	-4304 / 0	-91.8	-91.8 0.70 (1)	3.93	E-K	0 / 1729 0.15 (1)	
F-G	-4327 / 0	-91.8	-91.8 0.66 (1)	3.92	K-G	0 / 2508 0.31 (1)	
G-H	-4327 / 0	-91.8	-91.8 0.66 (1)	3.92	J-G	-368 / 0 0.05 (1)	
H-I	-4327 / 0	-91.8	-91.8 0.66 (1)	3.92	B-O	0 / 2889 0.38 (1)	
I-J	-4327 / 0	-91.8	-91.8 0.66 (1)	3.92	J-H	0 / 2191 0.27 (1)	
J-K	-2881 / 0	-91.8	-91.8 0.17 (1)	5.49	O-D	-1142 / 0 0.18 (1)	
K-L	-2881 / 0	0.0	0.0 0.10 (1)	7.81			
L-H	-2131 / 0	0.0	0.0 0.08 (1)	7.81			
P-T	0 / 0	-18.5	-18.5 0.03 (1)	10.00			
T-U	0 / 0	-18.5	-18.5 0.03 (1)	10.00			
U-O	0 / 0	-18.5	-18.5 0.03 (1)	10.00			
O-V	0 / 3445	-18.5	-18.5 0.35 (1)	10.00			
V-N	0 / 3445	-18.5	-18.5 0.35 (1)	10.00			
N-M	0 / 3445	-18.5	-18.5 0.35 (1)	10.00			
M-L	0 / 49	-18.5	-18.5 0.08 (4)	10.00			
L-K	0 / 425	0.0	0.0 0.10 (1)	10.00			
K-F	-853 / 0	0.0	0.0 0.08 (1)	7.81			
K-W	0 / 2117	-18.5	-18.5 0.17 (1)	10.00			
W-X	0 / 2117	-18.5	-18.5 0.17 (1)	10.00			
X-Y	0 / 2117	-18.5	-18.5 0.17 (1)	10.00			
Y-J	0 / 2117	-18.5	-18.5 0.17 (1)	10.00			
J-Z	0 / 0	-18.5	-18.5 0.08 (4)	10.00			
Z-AA	0 / 0	-18.5	-18.5 0.08 (4)	10.00			
AA-I	0 / 0	-18.5	-18.5 0.08 (4)	10.00			

JT	LOC.	LC1	FACTORED CONCENTRATED LOADS (LBS)		FACE	DIR.	TYPE	HEEL	CONN.
			MAX.	MAX+					
C	4-0-11	-49	-55	---	FRONT	VERT	DEAD	---	C1
C	4-0-11	-254	-254	---	FRONT	VERT	SNOW	---	C1
G	22-11-10	-21	-24	---	FRONT	VERT	DEAD	---	C1
G	22-11-10	-105	-105	---	FRONT	VERT	SNOW	---	C1
L	16-2-4	-375	-375	---	FRONT	VERT	TOTAL	---	C1
Q	17-11-4	-40	-40	---	FRONT	VERT	TOTAL	---	C1
R	19-11-4	-40	-40	---	FRONT	VERT	TOTAL	---	C1
S	21-11-4	-40	-40	---	FRONT	VERT	TOTAL	---	C1
T	9-4	-29	-29	---	FRONT	VERT	TOTAL	---	C1
U	2-9-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
V	4-8-8	-953	-953	---	FRONT	VERT	TOTAL	---	C1

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
 GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
 LOADS WERE DERIVED FROM USER INPUT
 NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
 ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBCC 2015, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.90")
 CALCULATED VERT. DEFL.(LL) = U/999 (0.09")
 ALLOWABLE DEFL.(TL) = L/360 (0.90")
 CALCULATED VERT. DEFL.(TL) = U/999 (0.17")

CSI: TC=0.70/1.00 (E-F:1), BC=0.35/1.00 (M-O:1);
 WB=0.38/1.00 (B-O:1), SS=0.29/1.00 (M-O:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP(DRY)		SHEAR		SECTION	
	(PSI)	(PL)	(PL)	(PL)	(PL)	(PL)
MT20	618	354	1687	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches
 PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (H) (INPUT = 0.90)
 JSI METAL = 0.34 (C) (INPUT = 1.00)

JOB NAME 408088	TRUSS NAME T20	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:03:31 2020 Page 2	
				ID:DMCubINVR6TstFoe31v6I zns1I-1mIHCKrTnhl8WNHr85MIXrm bpQu?Mu7st2cCkzNEXO	

PLATES (table in inches)


JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.50	3.00
C	TTW-m	MT20	4.0	4.0		
D	TTWW-m	MT20	4.0	8.0		
E	TTWW-m	MT20	5.0	8.0	2.00	2.75
F	TMV-p	MT20	3.0	4.0		
G	TTWW-m	MT20	5.0	8.0	2.00	3.00
H	TTWW-t	MT20	5.0	8.0	2.50	1.75
I	BMV1-p	MT20	3.0	6.0		
J	BMVW-t	MT20	5.0	6.0		
K	BMVWWW-t	MT20	8.0	12.0	4.50	4.50
L	BMV-p	MT20	3.0	6.0		
M	BMVWW-t	MT20	8.0	9.0		
N	BS-t	MT20	5.0	6.0		
O	BMVWW-t	MT20	5.0	8.0		
P	BMV1-p	MT20	3.0	6.0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
W	17-11-4	-8	-8	---	FRONT	VERT	TOTAL	---	C1
X	19-11-4	-8	-8	---	FRONT	VERT	TOTAL	---	C1
Y	21-11-4	-8	-8	---	FRONT	VERT	TOTAL	---	C1
Z	23-11-4	-8	-8	---	FRONT	VERT	TOTAL	---	C1
AA	25-11-4	-8	-8	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

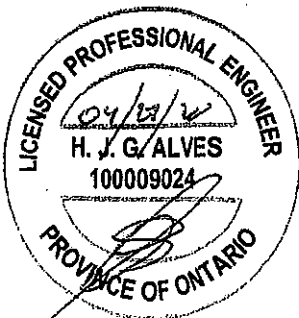

Structural component only
DWG# T-2006976

JOB NAME 408088	TRUSS NAME T21	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:03:32 2020 Page 1
ID:DMCubINVR6TslFoe31v6l_zns1I-VyrtPgr5Y?n78Xs2pt_42IDmKChzh47nAkAzNEXP

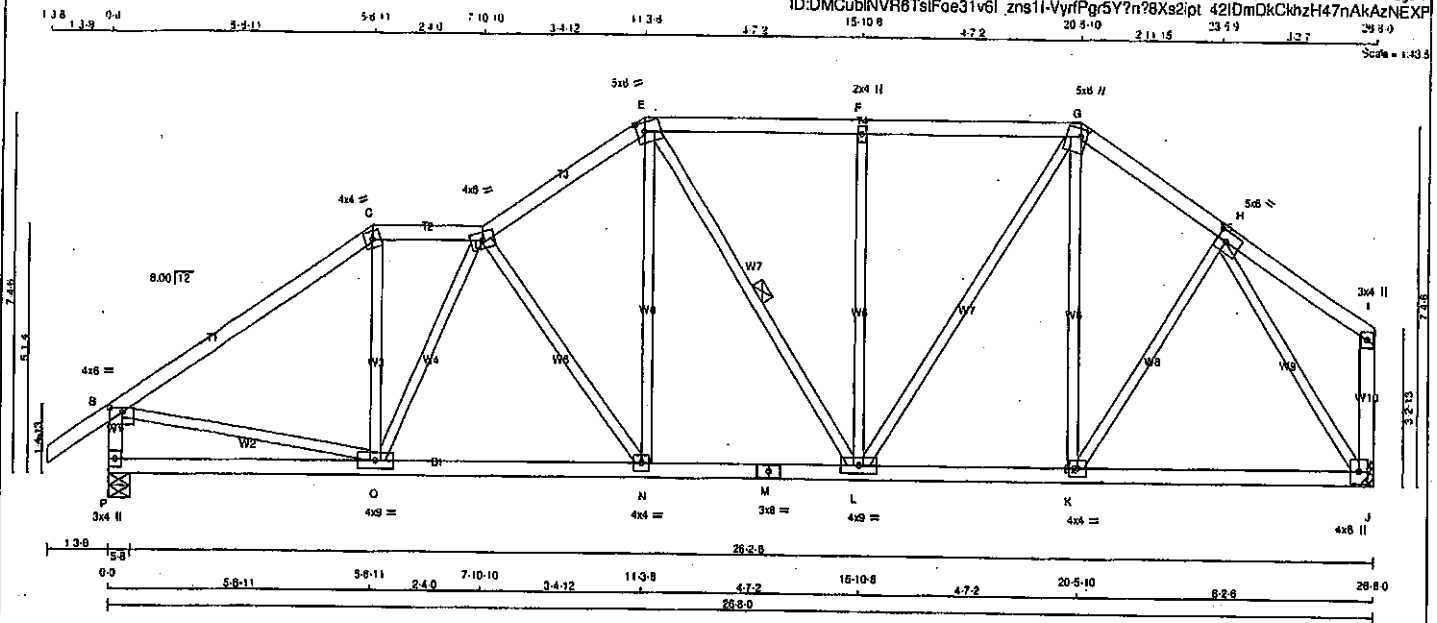

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
I - J	2x4	DRY	No.2	SPF
J - K	2x4	DRY	No.2	SPF
K - L	2x4	DRY	No.2	SPF
L - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMWV-p	MT20	4.0	6.0	1.00	3.25
C TTW-m	MT20	4.0	4.0		
D TTWV-m	MT20	4.0	8.0		
E TTWV-m	MT20	5.0	5.0	2.25	2.00
F TMWV-m	MT20	2.0	4.0		
G TTWV-m	MT20	5.0	8.0	2.00	1.50
H TMWV-l	MT20	5.0	6.0	2.50	2.25
I TMV-p	MT20	3.0	4.0		
J BMWV-l-p	MT20	4.0	6.0		
K BMWV-l	MT20	4.0	4.0		
L BMWV-l	MT20	4.0	9.0		
M BS-l	MT20	3.0	6.0		
N BMWV-l	MT20	4.0	4.0		
O BMWV-l	MT20	4.0	9.0		
P BMV-l-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
P	1596 0	1596 0	0	5-8
J	1470 0	1470 0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
P	1125	752 / 0	0 / 0	0 / 0	0 / 0	374 / 0	0 / 0
J	1040	682 / 0	0 / 0	0 / 0	0 / 0	357 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS (L/C)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (L/C)	
FR-TO				FR-TO			
A-B	0 / 35	-81.8	-81.8 0.12 (1)	10.00	O-C	0 / 552	0.12 (1)
B-C	-1642 / 0	-81.8	-81.8 0.42 (1)	4.72	D-N	-585 / 0	0.35 (1)
C-D	-1383 / 0	-81.8	-81.8 0.08 (1)	5.48	N-E	0 / 587	0.13 (1)
D-E	-1625 / 0	-81.8	-81.8 0.17 (1)	5.05	E-L	-9 / 15	0.00 (4)
E-F	-1389 / 0	-81.8	-81.8 0.28 (1)	5.27	L-F	-512 / 0	0.49 (1)
F-G	-1359 / 0	-81.8	-81.8 0.23 (1)	5.27	L-G	0 / 675	0.15 (1)
G-H	-1228 / 0	-81.8	-81.8 0.12 (1)	5.68	K-G	-170 / 8	0.16 (1)
H-I	0 / 17	-81.8	-81.8 0.13 (1)	10.00	K-H	0 / 349	0.08 (1)
P-B	-1552 / 0	0.0	0.0 0.18 (1)	6.61	B-O	0 / 1389	0.31 (1)
J-I	-110 / 0	0.0	0.0 0.02 (1)	7.61	H-J	-1544 / 0	0.88 (1)
					O-D	-760 / 0	0.38 (1)
P-O	0 / 0	-18.5	-18.5 0.14 (4)	10.00			
O-N	0 / 1897	-18.5	-18.5 0.34 (1)	10.00			
N-M	0 / 1381	-18.5	-18.5 0.28 (1)	10.00			
M-L	0 / 1381	-18.5	-18.5 0.28 (1)	10.00			
L-K	0 / 1001	-18.5	-18.5 0.25 (1)	10.00			
K-J	0 / 813	-18.5	-18.5 0.22 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.89")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (0.89")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.42/1.00 (B-C:1), BC=0.34/1.00 (N-O:1), WB=0.88/1.00 (H-J:1), SSI=0.20/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (H) (INPUT = 0.90)
JSI METAL= 0.44 (M) (INPUT = 1.00)

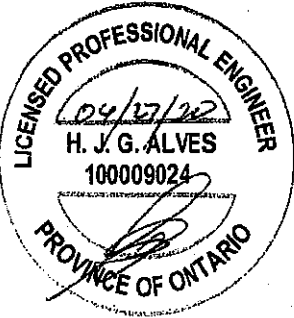


Structural component only
DWG# T-2008977

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408088	T22	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 \$ Oct 29 2019 MITek Industries, Inc. Sat Apr 25 09:03:33 2020 Page 1
ID:DMCubINVR6Ts[Foe31v6]_zns1L-z8P1d0sJjUvsmhREGWPDdGrMzd5YTIsQJnXjHczNEXO

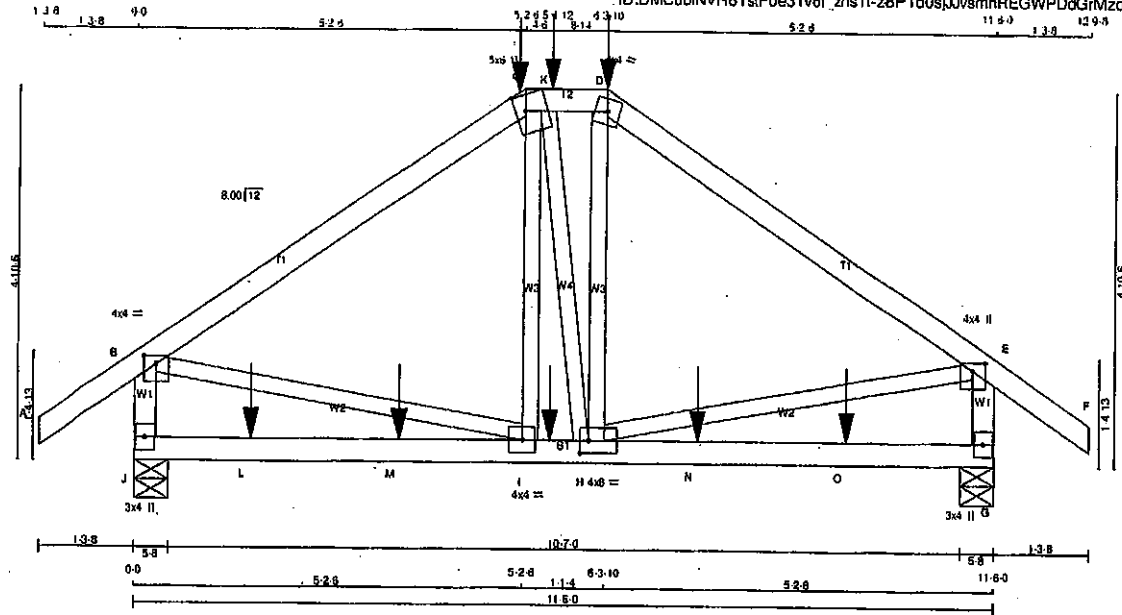

Scale = 1/2"

TOTAL WEIGHT = 53 b

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
J - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
J - G	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	VERT	HORZ	GROSS REACTION	GROSS REACTION	BRG	BRG	IN-SX	IN-SX
J	1103	0	1103	0	0	5-8	5-8		
G	1095	0	1095	0	0	5-8	5-8		

UNFACTORED REACTIONS		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SC
J	776	531 / 0	0 / 0	0 / 0	0 / 0	245 / 0	0 / 0
G	771	529 / 0	0 / 0	0 / 0	0 / 0	242 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.57 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	LC1 MAX. (PLF)	MAX. UNBRAC. LENGTH (FT)	MEMB.	FORCE (LBS)	MAX. CSI (LC)
FR-TO					FR-TO		
A-B	0 / 35	-91.8	-91.8	0.14 (1)	I-C	-59 / 58	0.02 (1)
B-C	-943 / 0	-91.8	-91.8	0.52 (1)	C-H	-23 / 0	0.01 (1)
C-K	-778 / 0	-91.8	-91.8	0.07 (1)	H-D	-41 / 63	0.02 (4)
K-D	-778 / 0	-91.8	-91.8	0.07 (1)	B-I	0 / 800	0.20 (1)
D-E	-939 / 0	-91.8	-91.8	0.52 (1)	H-E	0 / 796	0.20 (1)
E-F	0 / 35	-91.8	-91.8	0.14 (1)			
J-B	-1049 / 0	0.0	0.0	0.12 (1)			
G-E	-1042 / 0	0.0	0.0	0.12 (1)			
J-L	0 / 0	-18.5	-18.5	0.19 (4)			
L-M	0 / 0	-18.5	-18.5	0.19 (4)			
M-I	0 / 0	-18.5	-18.5	0.19 (4)			
I-H	0 / 783	-18.5	-18.5	0.27 (4)			
H-N	0 / 0	-18.5	-18.5	0.20 (4)			
N-O	0 / 0	-18.5	-18.5	0.20 (4)			
O-G	0 / 0	-18.5	-18.5	0.20 (4)			

FACTORED CONCENTRATED LOADS (LBS)		FACE		DIR.		TYPE		HEEL		CONN.	
JT	LOC.	LC1	MAX.	FRONT	VERT	DEAD					
C	5-2-6	-38	-42	---	---	---	---	---	---	C1	
C	5-2-6	-195	-195	---	---	---	---	---	---	C1	
D	8-3-10	-38	-42	---	---	---	---	---	---	C1	
D	8-3-10	-195	-195	---	---	---	---	---	---	C1	
I	5-6-12	-17	-17	---	---	---	---	---	---	C1	
K	5-6-12	-127	-127	---	---	---	---	---	---	C1	
L	1-6-12	-17	-17	---	---	---	---	---	---	C1	
M	3-6-12	-17	-17	---	---	---	---	---	---	C1	
N	7-6-12	-17	-17	---	---	---	---	---	---	C1	
O	9-6-12	-17	-17	---	---	---	---	---	---	C1	

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.38")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.38")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.52/1.00 (B-C:1), BC=0.27/1.00 (H-I:4), WB=0.20/1.00 (B-I:1), SSI=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1668

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.80 (I) JSI INPUT = 0.90
JSI METAL = 0.31 (B) JSI INPUT = 1.00 I




Structural component only
DWG# T-2006978

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408088	T23	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 09:03:34 2020 Page 1
ID:DMCubINVR8TstF0e31v8f_zns1f-RLzPqMIL4ctjNr0CqDwS9TOZi0TicNrZRYGGp3zNEXN

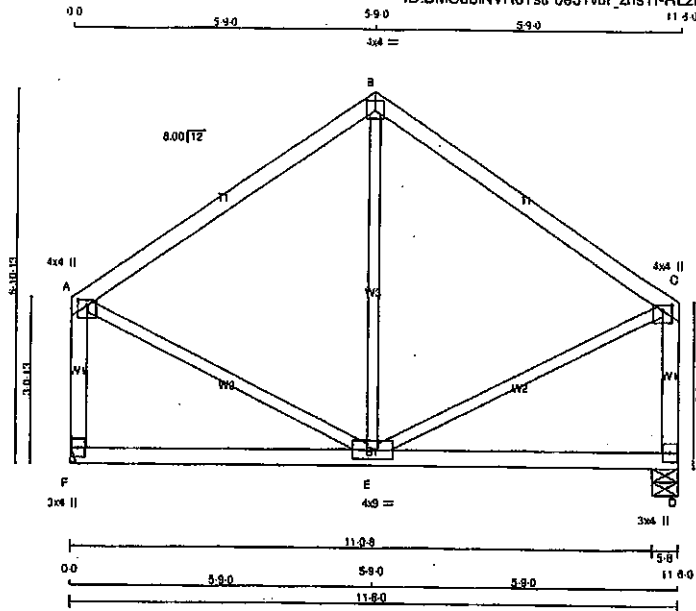

Scale = 1/32"

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - B	2x4	DRY	No.2	
B - C	2x4	DRY	No.2	
F - A	2x4	DRY	No.2	
D - C	2x4	DRY	No.2	
F - D	2x4	DRY	No.2	
ALL WEBS	2x3	DRY	No.2	
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TTW+p	MT20	4.0	4.0	2.25	2.00
C	TMVW+p	MT20	4.0	4.0	1.25	2.00
D	BMVt+p	MT20	3.0	4.0		
E	BMVWW-t	MT20	4.0	9.0		
F	BMVt+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	834	0	834	0
D	834	0	834	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	448	294 / 0	0 / 0	0 / 0	0 / 0	154 / 0	0 / 0
D	448	294 / 0	0 / 0	0 / 0	0 / 0	154 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	FACTORED	FACTORED	WEBS	MAX. FACTORED	FACTORED	FACTORED	FACTORED
MEMB.	FORCE	VERT. LOAD	LC1	MAX	MEMB.	FORCE	VERT. LOAD	LC1	MAX
FR-TO	(LBS)	(PLF)	CSI (LC)	UNBRAC	FR-TO	(LBS)	(PLF)	CSI (LC)	UNBRAC
A-B	-348 / 0	-91.8	-91.8	0.39 (1)	8.25	E-B	-144 / 46	0.11 (1)	
B-C	-348 / 0	-91.8	-91.8	0.39 (1)	8.25	A-E	0 / 319	0.07 (1)	
F-A	-593 / 0	0.0	0.0	0.10 (1)	7.81	E-C	0 / 319	0.07 (1)	
D-C	-593 / 0	0.0	0.0	0.10 (1)	7.81				
F-E	0 / 0	-18.5	-18.5	0.18 (4)	10.00				
E-D	0 / 0	-18.5	-18.5	0.18 (4)	10.00				

TOTAL WEIGHT = 2 X 50 = 100 lb (M)F

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBCG 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.38")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.38")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.39/1.00 (B-C:1), BC=0.18/1.00 (D-E:4), WB=0.17/1.00 (B-E:1), SSI=0.17/1.00 (B-C:1)

DOL LUMBER-1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1858

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.41 (A) (INPUT = 0.90)
JSI METAL= 0.12 (A) (INPUT = 1.00)




Structural component only
DWG# T-2006979

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408088	T23A	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:33:35 2020 Page 1
ID:DMCubINVR6TstFoe31v8l_zns11-vXXn2iuzw9a?_bdNxRhikwKSQojEajm50qLVzNEXM

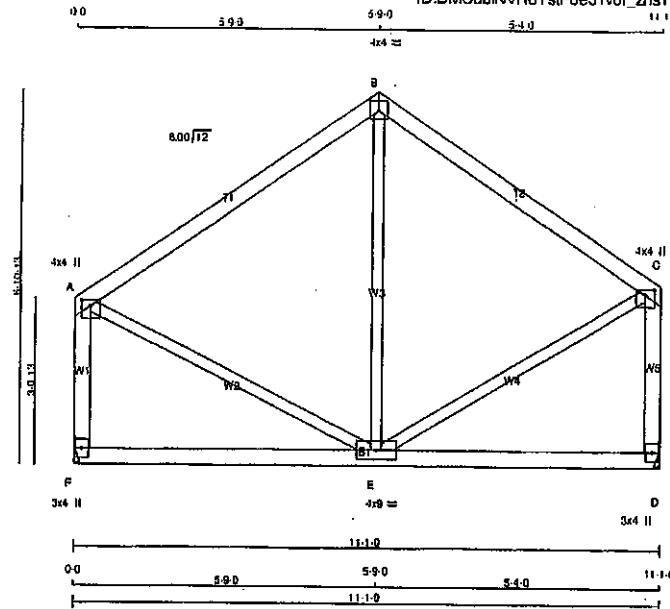

Scale = 1/32

LUMBER				DESCR.	
N. L. G. A. RULES	SIZE	LUMBER		SPF	
CHORDS					
A - B	2x4	DRY	No.2	SPF	
B - C	2x4	DRY	No.2	SPF	
F - A	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
OXY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW+P	MT20	4.0	4.0	1.25 2.00
B	TTW+P	MT20	4.0	4.0	2.25 2.00
C	TMVW+P	MT20	4.0	4.0	1.25 2.00
D	BMVt+P	MT20	3.0	4.0	
E	BMVWW+P	MT20	4.0	9.0	
F	BMVt+P	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	611	0	611	0
D	611	0	611	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D. MINIMUM BEARING LENGTH AT JOINT F = 1-8, JOINT D = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	432	284 / 0	0 / 0	0 / 0	0 / 0	149 / 0	0 / 0
D	432	284 / 0	0 / 0	0 / 0	0 / 0	149 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	-321 / 0	-91.8 -91.8	0.39 (1)	E-B	-152 / 39	0.12 (1)	
B-C	-321 / 0	-91.8 -91.8	0.33 (1)	A-E	0 / 298	0.07 (1)	
F-A	-570 / 0	0.0 0.0	0.09 (1)	E-C	0 / 307	0.07 (1)	
D-C	-574 / 0	0.0 0.0	0.11 (1)				
F-E	0 / 0	-18.5 -18.5	0.16 (4)				
E-D	0 / 0	-18.5 -18.5	0.16 (4)				

TOTAL WEIGHT = 49 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.37")
CALCULATED VERT. DEFL.(LL) = 1/989 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.37")
CALCULATED VERT. DEFL.(TL) = 1/989 (0.03")

CSI: TC=0.39/1.00 (A-B:1), BC=0.16/1.00 (E-F:4),
WB=0.12/1.00 (B-E:1), SS=0.17/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.40 (C) (INPUT = 0.90)
JSI METAL= 0.12 (C) (INPUT = 1.00)




Structural component only
DWG# T-2006980

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408088	T24	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITEX Industries, Inc. Sat Apr 25 09:03:38 2020 Page 1
ID:DMCubINVR6TstF0a31v6I_zns11-OJAF2ubcEIRd8ApaywEuTIGq4lgoms?IINlxzNEXL

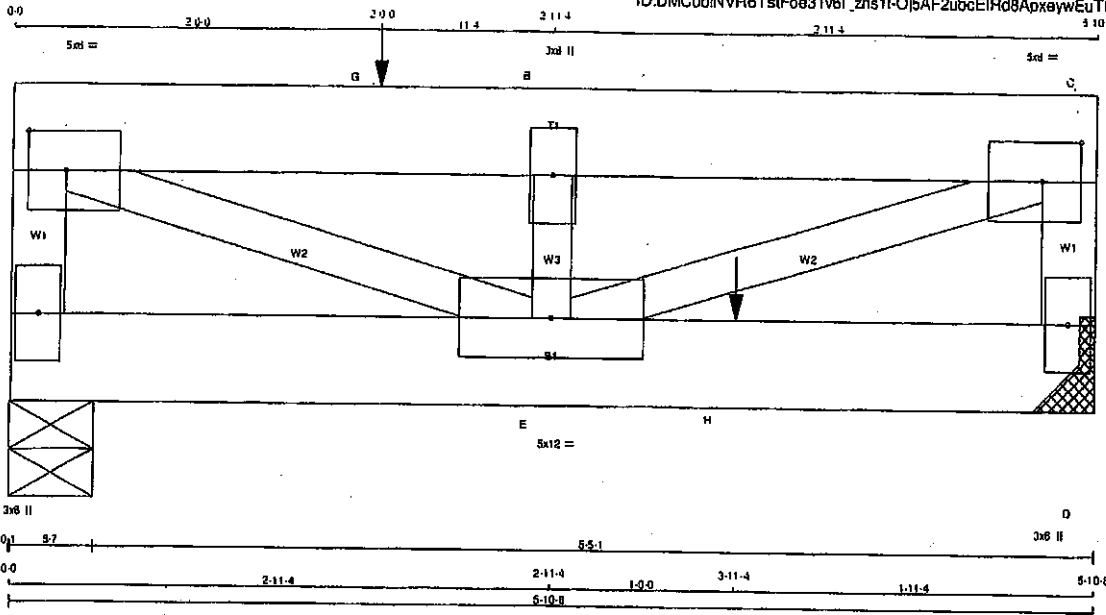

TOTAL WEIGHT = 2 X 28 = 55 lb

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESC
F - A	2x4	DRY	No.2		SPF
A - C	2x6	DRY	No.2		SPF
D - C	2x4	DRY	No.2		SPF
F - D	2x6	DRY	No.2		SPF
ALL WEBS		2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.					

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F-A 1	12	TOP
C-D 1	12	TOP
A-C 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F-D 2	12	SIDE(14.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+	MT20	5.0	6.0	2.50	2.50
B	TMVW+	MT20	3.0	6.0		
C	TMVW+	MT20	5.0	6.0	2.50	2.50
D	BMV1+p	MT20	3.0	6.0		
E	BMVWW+	MT20	5.0	12.0		
F	BMV1+p	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
F	2237 0	2237 0	5-8 (5-7)	5-8
D	2073 0	2073 0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

VALUE IN PARENTHESES INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	1688	1010 / 0	0 / 0	0 / 0	0 / 0	577 / 0	0 / 0
D	1471	935 / 0	0 / 0	0 / 0	0 / 0	538 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.32 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO									
F-A	-2132 / 0	0.0	0.0	0.12 (1)	7.80	A-E	0 / 3589	0.44 (1)	
A-G	-3319 / 0	-91.8	-91.8	0.51 (1)	5.32	E-B	-1728 / 0	0.13 (1)	
G-B	-3319 / 0	-91.8	-91.8	0.51 (1)	5.32	E-C	0 / 3589	0.44 (1)	
B-C	-3319 / 0	-91.8	-91.8	0.04 (1)	6.07				
D-C	-1473 / 0	0.0	0.0	0.08 (1)	7.81				
F-E	0 / 0	-43.5	-43.5	0.05 (1)	10.00				
E-H	0 / 0	-43.5	-43.5	0.40 (1)	10.00				
H-D	0 / 0	-43.5	-43.5	0.40 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	2-0-0	-2064	-2064		TOP	VERT	TOTAL		C1
H	3-11-4	-1452	-1452		BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***

GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.

LOADS WERE DERIVED FROM USER INPUT NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OF SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")

CALCULATED VERT. DEFL.(LL) = L/989 (0.02")

ALLOWABLE DEFL.(TL) = L/360 (0.20")

CALCULATED VERT. DEFL.(TL) = L/989 (0.05")

CSI: TC=0.51/1.00 (A-B:1), BC=0.40/1.00 (D-E:1), WB=0.44/1.00 (A-E:1), SSI=0.52/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES	PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1687
	354	1687	1687

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (A:1) INPUT = 0.90 ;

JSI METAL= 0.41 (C:1) INPUT = 1.00 ;

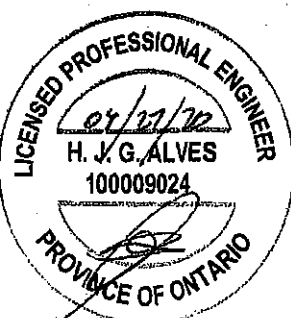


Structural component only
DWG# T-2006981

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408089	T30	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 09:25:40 2020 Page 1	

ID:DMCubINVR6TstFoe31v6t_zns11-dR5h7mw5015aScOGviiPv5J4SYwwwK4iSKTRLCzNEC

Scale = 1:57.3

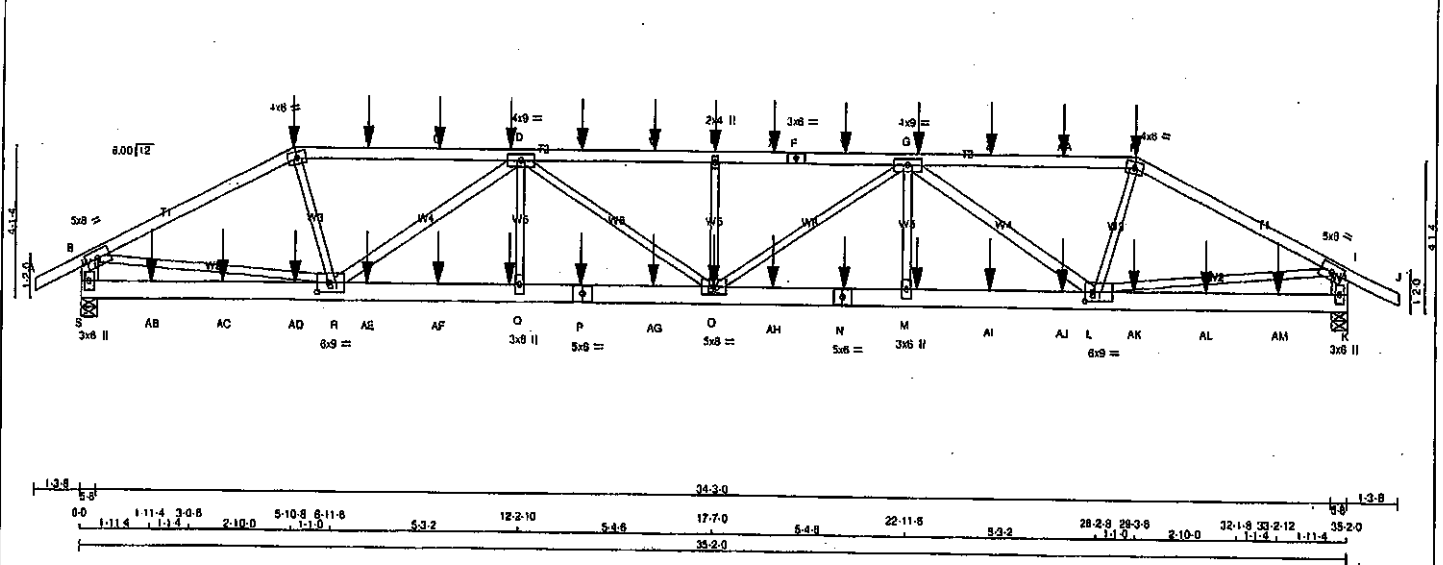

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF
S - B	2x6	DRY	No.2	SPF
K - I	2x6	DRY	No.2	SPF
S - P	2x6	DRY	No.2	SPF
P - N	2x6	DRY	No.2	SPF
N - K	2x6	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS	ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122'x3') SPIRAL NAILS			
A-C	1	12	SIDE(0.0)
C-F	1	12	SIDE(61.0)
F-H	1	12	SIDE(61.0)
H-J	1	12	SIDE(0.0)
S-B	2	12	TOP
K-I	2	12	TOP
BOTTOM CHORDS: (0.122'x3') SPIRAL NAILS			
S-P	2	12	SIDE(183.1)
P-N	2	12	SIDE(183.1)
N-K	2	12	SIDE(183.1)
WEBS: (0.122'x3') SPIRAL NAILS			
2x3	1	6	
2x4	1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
S	3321	0	3321	0	0	5-8	5-8	5-8	5-8
K	3321	0	3321	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		MAX / MIN. COMPONENT REACTIONS					
JT	1ST LCASE COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	2351	1532 / 0	0 / 0	0 / 0	0 / 0	818 / 0	0 / 0
K	2351	1532 / 0	0 / 0	0 / 0	0 / 0	818 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.81 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX.	FACTORED	FACTORED
FR-TO											
A-B	0 / 28	-91.8	-91.8	0.07 (1)	10.00	M-G	0 / 183	0.03 (4)			
B-C	-5188 / 0	-91.8	-91.8	0.04 (1)	3.82	Q-D	0 / 183	0.03 (4)			
C-D	-5050 / 0	-91.8	-91.8	0.04 (1)	3.70	O-G	0 / 744	0.09 (1)			
T-U	-5050 / 0	-91.8	-91.8	0.04 (1)	3.70	D-O	0 / 744	0.09 (1)			
U-V	-5050 / 0	-91.8	-91.8	0.04 (1)	3.70	E-H	-701 / 0	0.09 (1)			
D-V	-7883 / 0	-91.8	-91.8	0.01 (1)	2.81	G-R	0 / 1384	0.17 (1)			
V-W	-7883 / 0	-91.8	-91.8	0.01 (1)	2.81	R-R	0 / 4688	0.58 (1)			
W-E	-7883 / 0	-91.8	-91.8	0.01 (1)	2.81	R-O	-2747 / 0	0.73 (1)			
E-X	-7883 / 0	-91.8	-91.8	0.01 (1)	2.81	L-H	0 / 1384	0.17 (1)			
X-F	-7883 / 0	-91.8	-91.8	0.01 (1)	2.81	L-I	0 / 4688	0.58 (1)			
F-Y	-7883 / 0	-91.8	-91.8	0.01 (1)	2.81	G-L	-2747 / 0	0.73 (1)			
Y-G	-7883 / 0	-91.8	-91.8	0.01 (1)	2.81						
G-Z	-5050 / 0	-91.8	-91.8	0.04 (1)	3.70						
Z-AA	-5050 / 0	-91.8	-91.8	0.04 (1)	3.70						
AA-H	-5050 / 0	-91.8	-91.8	0.04 (1)	3.70						
H-I	-5188 / 0	-91.8	-91.8	0.04 (1)	3.82						
I-J	0 / 28	-91.8	-91.8	0.07 (1)	10.00						
S-B	-3222 / 0	0.0	0.0	0.11 (1)	7.71						
K-I	-3222 / 0	0.0	0.0	0.11 (1)	7.71						

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 0.0 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.09/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')

CALCULATED VERT. DEFL.(LL) = L/998 (0.23')

ALLOWABLE DEFL.(TL) = L/360 (1.17')

CALCULATED VERT. DEFL.(TL) = L/971 (0.43')

CSI: TC=0.81/1.00 (D-E:1), BC=0.53/1.00 (M-O:1), WB=0.73/1.00 (D-R:1), SS=0.21/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1687 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.83 (R) (INPUT = 0.90)

JSI METAL= 0.68 (P) (INPUT = 1.00)



Structural component only

DWG# T-2006996

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
B	TMW-t	MT20	5.0	8.0		
C	TTW-m	MT20	4.0	6.0		
D	TMWWW-t	MT20	4.0	9.0		
E	TMW-w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMWWW-t	MT20	4.0	9.0		
H	TTW-m	MT20	4.0	6.0		
I	TMW-t	MT20	5.0	8.0		
K	BMV-t+p	MT20	3.0	6.0		
L	BMWWW-t	MT20	6.0	9.0	3.00	2.75
M	BMW-w	MT20	3.0	6.0		
N	BS-t	MT20	5.0	6.0		
O	BMWWW-t	MT20	5.0	8.0		
P	BS-t	MT20	5.0	6.0		
Q	BMW-w	MT20	3.0	6.0		
R	BMWWW-t	MT20	6.0	9.0	3.00	3.75
S	BMV-t+p	MT20	3.0	6.0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-15	-428	-428	---	FRONT	VERT	TOTAL	---	C1
D	11-11-3	-110	-110	---	FRONT	VERT	TOTAL	---	C1
E	17-7-0	-110	-110	---	FRONT	VERT	TOTAL	---	C1
G	23-2-13	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	29-3-1	-428	-428	---	FRONT	VERT	TOTAL	---	C1
M	23-2-13	-28	-28	---	FRONT	VERT	TOTAL	---	C1
N	21-2-13	-28	-28	---	FRONT	VERT	TOTAL	---	C1
O	17-7-0	-28	-28	---	FRONT	VERT	TOTAL	---	C1
P	13-11-3	-28	-28	---	FRONT	VERT	TOTAL	---	C1
Q	11-11-3	-28	-28	---	FRONT	VERT	TOTAL	---	C1
T	7-11-3	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-3	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	13-11-3	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	15-11-3	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	19-2-13	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	21-2-13	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	25-2-13	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	27-2-13	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	1-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AC	3-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AD	5-11-3	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AE	7-11-3	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AF	9-11-3	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AG	15-11-3	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AH	19-2-13	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AI	25-2-13	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AJ	27-2-13	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AK	29-2-13	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AL	31-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AM	33-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

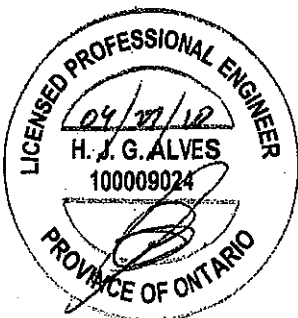

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408089	T30Z	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:25:41 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-5ef4L6xjZKDQ4mzT3QDsrJrEzxFsdkeuhOD7ue2NECE

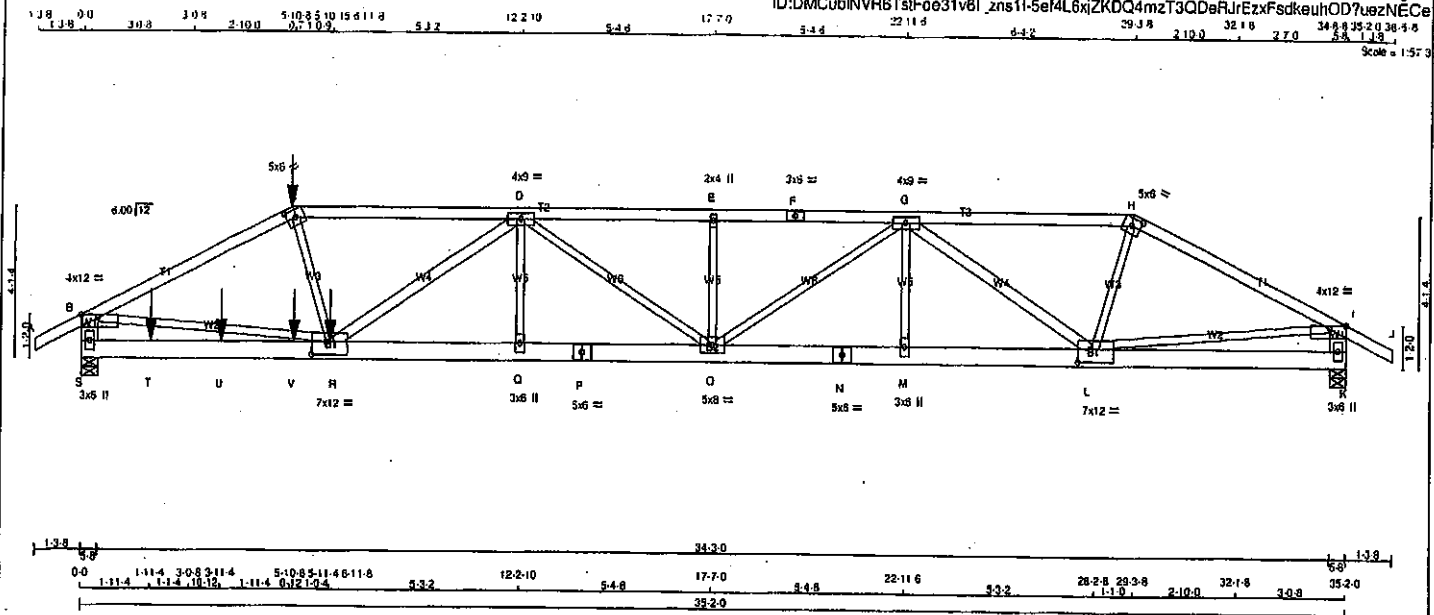

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x6	DRY	No.2
K - I	2x8	DRY	No.2
S - P	2x8	DRY	No.2
P - N	2x8	DRY	No.2
N - K	2x6	DRY	No.2
ALL WEBS EXCEPT R - D & L	2x3	DRY	No.2

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS: (0.122'X3') SPIRAL NAILS		
A-C	12	SIDE(0.0)
C-F	12	SIDE(0.0)
F-H	12	TOP
H-J	12	TOP
S-B	12	TOP
K-I	12	TOP
BOTTOM CHORDS: (0.122'X3') SPIRAL NAILS		
S-P	12	SIDE(0.0)
P-N	12	TOP
N-K	12	TOP
WEBS: (0.122'X3') SPIRAL NAILS		
2x3	6	
2x4	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERT	HORZ	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
S	4929	0	0	4929	0	0	5-8	5-8	5-8
K	2780	0	0	2780	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	3479	2322 / 0	0 / 0	0 / 0	0 / 0	1157 / 0	0 / 0
K	1948	1302 / 0	0 / 0	0 / 0	0 / 0	648 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.93 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. (LC1)	MEMB.	FORCE (LBS)	MAX. (LC)	CS1 (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 28	-91.8	-91.8 0.07 (1)	10.00	M-G	0 / 124	0.02 (4)
B-C	-8095 / 0	-91.8	-91.8 0.83 (1)	2.93	C-D	0 / 145	0.02 (4)
C-D	-8090 / 0	-91.8	-91.8 0.75 (1)	3.02	O-G	0 / 1623	0.20 (1)
D-E	-7855 / 0	-91.8	-91.8 0.82 (1)	3.08	D-O	-810 / 0	0.31 (1)
E-F	-7855 / 0	-91.8	-91.8 0.83 (1)	3.08	O-E	-405 / 0	0.05 (1)
F-G	-7855 / 0	-91.8	-91.8 0.63 (1)	3.08	C-R	0 / 2815	0.35 (1)
G-H	-4203 / 0	-91.8	-91.8 0.41 (1)	4.23	B-R	0 / 7263	0.90 (1)
H-I	-4212 / 0	-91.8	-91.8 0.46 (1)	4.23	R-D	-531 / 0	0.14 (1)
I-J	0 / 28	-91.8	-91.8 0.07 (1)	10.00	L-H	0 / 1446	0.18 (1)
S-B	-4807 / 0	0.0	0.0 0.17 (1)	6.61	L-I	0 / 3789	0.47 (1)
K-I	-2691 / 0	0.0	0.0 0.09 (1)	7.81	G-L	-2867 / 0	0.76 (1)
S-T	0 / 0	-18.5	-18.5 0.11 (4)	10.00			
T-U	0 / 0	-18.5	-18.5 0.11 (4)	10.00			
U-V	0 / 0	-18.5	-18.5 0.11 (4)	10.00			
V-R	0 / 0	-18.5	-18.5 0.11 (4)	10.00			
R-Q	0 / 8520	-18.5	-18.5 0.62 (1)	10.00			
Q-P	0 / 8520	-18.5	-18.5 0.61 (1)	10.00			
P-O	0 / 8520	-18.5	-18.5 0.61 (1)	10.00			
O-N	0 / 6522	-18.5	-18.5 0.48 (1)	10.00			
N-M	0 / 6522	-18.5	-18.5 0.48 (1)	10.00			
M-L	0 / 6522	-18.5	-18.5 0.45 (1)	10.00			
L-K	0 / 0	-18.5	-18.5 0.06 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-15	-428	-428	---	BACK	VERT	TOTAL	---	C1
R	6-11-8	-3058	-3058	---	BACK	VERT	TOTAL	---	C1
T	1-11-4	-25	-25	---	BACK	VERT	TOTAL	---	C1
U	3-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
V	5-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

11 C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.26')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/913 (0.46')

CSI: TC=0.83/1.00 (B-C:1), BC=0.62/1.00 (C-R:1), WB=0.90/1.00 (B-R:1), SSI=0.15/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLD)
MAX MIN MAX MIN MAX MIN
MT20 818 364 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (R) (INPUT = 0.90)
JSI METAL= 0.77 (P) (INPUT = 1.00)



Structural component only
DWG# T-2006997 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRAWG NO.
408089	T30Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:25:41 2020 Page 2
ID:DMCubINVR8TstFoe31v6L_zns1l-5ef4L6xiZKQ4mzT3QDeRjrEzxFsdkehOD?uezNECe

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	12.0	1.00	5.50
C	TTW-h	MT20	5.0	6.0	2.50	3.00
D	TMWWW-t	MT20	4.0	9.0		
E	TMW-w	MT20	2.0	4.0		
F	TS-l	MT20	3.0	6.0		
G	TMWWW-t	MT20	4.0	9.0		
H	TTW-h	MT20	5.0	6.0	2.50	3.00
I	TMVW-p	MT20	4.0	12.0	1.00	5.50
K	BMV1-p	MT20	3.0	6.0		
L	BMWWW-t	MT20	7.0	12.0	4.25	4.50
M	BMW-w	MT20	3.0	6.0		
N	BS-l	MT20	5.0	6.0		
O	BMWWW-t	MT20	5.0	8.0		
P	BS-l	MT20	5.0	6.0		
Q	BMW-w	MT20	3.0	6.0		
R	BMWWW-t	MT20	7.0	12.0	4.25	5.00
S	BMV1-p	MT20	3.0	6.0		




Structural component only
DWG# T-2006997 3/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408089	T31	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:25:42 2020 Page 1
ID:DMCubINVR6TstFoe31v6i_zns1l-ZqDSYSymKELHwYid7it_WONsLajMD21w2yYQ4zNECd

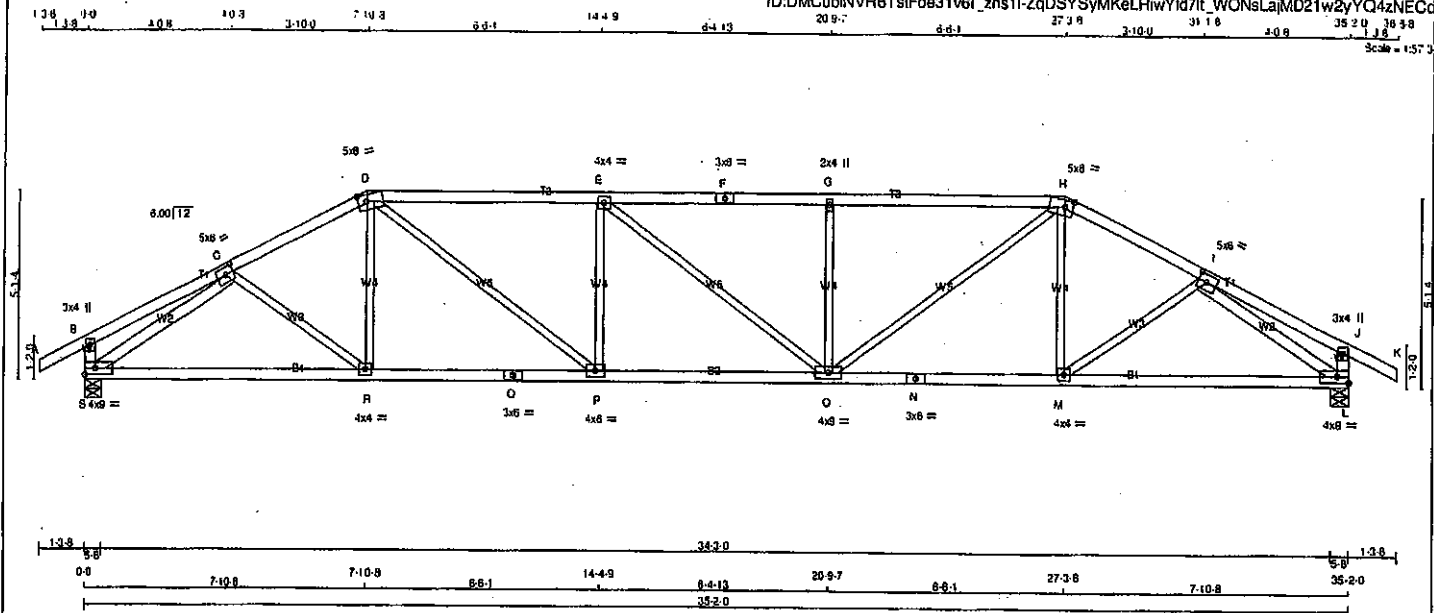

TOTAL WEIGHT = 2 X 139 = 278 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
C	TMWW-1	MT20	5.0	8.0 2.50 2.75
D	TMWW-m	MT20	5.0	8.0 2.25 2.75
E	TMWW-1	MT20	4.0	4.0
F	TS-1	MT20	3.0	8.0
G	TMN+w	MT20	2.0	4.0
H	TMWW-m	MT20	5.0	8.0 2.25 2.75
I	TMWW-1	MT20	5.0	8.0 2.50 2.75
J	TMV+p	MT20	3.0	4.0
L	BMVW-1	MT20	4.0	9.0 Edge
M	BMVW-1	MT20	4.0	4.0
N	BS-1	MT20	3.0	8.0
O	BMVWW-1	MT20	4.0	9.0
P	BMVWW-1	MT20	4.0	8.0
Q	BS-1	MT20	3.0	8.0
R	BMVWW-1	MT20	4.0	4.0
S	BMVW-1	MT20	4.0	9.0 Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORZ	BRG	BRG	IN-SX	IN-SX
S	2083	0	2083	0	0	5-8	5-8		
L	2083	0	2083	0	0	5-8	5-8		

UNFACTORED REACTIONS

1ST LOASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.94 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. (CSI (LC))	MEMB.	FORCE (LBS)	MAX. (CSI (LC))	MAX. (CSI (LC))
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	C-R	0 / 93	0.03 (4)
B-C	0 / 10	-91.8	-91.8 0.20 (1)	10.00	R-D	0 / 121	0.04 (4)
C-D	-2799 / 0	-91.8	-91.8 0.32 (1)	3.88	D-P	0 / 1267	0.28 (1)
D-E	-3508 / 0	-91.8	-91.8 0.35 (1)	2.84	P-E	-843 / 0	0.25 (1)
E-F	-3507 / 0	-91.8	-91.8 0.33 (1)	2.94	E-O	-2 / 0	0.00 (1)
F-G	-3507 / 0	-91.8	-91.8 0.33 (1)	2.94	O-G	-843 / 0	0.25 (1)
G-H	-3507 / 0	-91.8	-91.8 0.34 (1)	2.85	O-H	0 / 1266	0.28 (1)
H-I	-2799 / 0	-91.8	-91.8 0.32 (1)	3.88	M-H	0 / 121	0.04 (4)
I-J	0 / 16	-91.8	-91.8 0.20 (1)	10.00	M-I	0 / 93	0.03 (4)
J-K	0 / 28	-91.8	-91.8 0.12 (1)	10.00	S-C	-2974 / 0	0.83 (1)
S-B	-270 / 0	0.0	0.0 0.03 (1)	7.81	I-L	-2974 / 0	0.83 (1)
L-J	-270 / 0	0.0	0.0 0.03 (1)	7.81			
S-R	0 / 2417	-18.5	-18.5 0.53 (1)	10.00			
R-Q	0 / 2489	-18.5	-18.5 0.54 (1)	10.00			
Q-P	0 / 2489	-18.5	-18.5 0.54 (1)	10.00			
P-O	0 / 3509	-18.5	-18.5 0.54 (1)	10.00			
O-N	0 / 2489	-18.5	-18.5 0.54 (1)	10.00			
N-M	0 / 2489	-18.5	-18.5 0.54 (1)	10.00			
M-L	0 / 2417	-18.5	-18.5 0.53 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 N/C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/989 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/989 (0.41")

CSI: TC=0.95/1.00 (D-E-1), BC=0.64/1.00 (O-P-1),
WB=0.83/1.00 (I-L-1), SSI=0.28/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE NEEDS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSH) (PLJ) (PLJ)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.89 (L) (INPUT = 0.90)
JSI METAL= 0.77 (N) (INPUT = 1.00)



Structural component only
DWG# T-2006998

JOB NAME 408089	TRUSS NAME T32	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:25:43 2020 Page 1		ID:DMCubINVR6TstFoe31v6l_zns11-10nqloy_5yU8H6rArG6WkxAlz25j8BBii5yXzNEC	

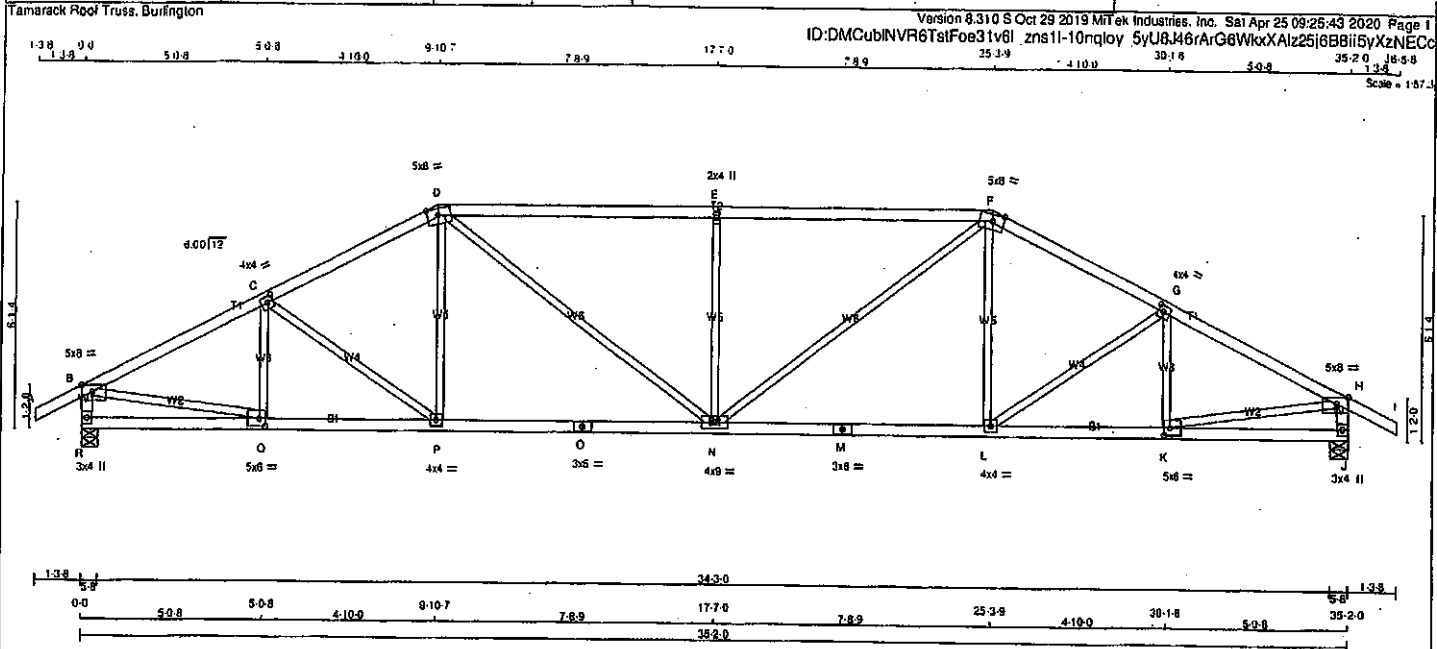

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMWV-p	MT20	5.0	8.0 Edge 3.50
C	TMWV-t	MT20	4.0	4.0 2.00 1.75
D	TTWV-m	MT20	5.0	8.0 2.25 3.75
E	TMWV-w	MT20	2.0	4.0
F	TTWV-m	MT20	5.0	8.0 2.25 3.75
G	TMWV-t	MT20	4.0	4.0 2.00 1.75
H	TMWV-p	MT20	5.0	8.0 Edge 3.50
J	BMV1-p	MT20	3.0	4.0
K	BMWV-t	MT20	5.0	8.0 2.50 2.00
L	BMWV-t	MT20	4.0	4.0
M	BS-t	MT20	3.0	6.0
N	BMWVW-t	MT20	4.0	9.0
O	BS-t	MT20	3.0	6.0
P	BMWV-t	MT20	4.0	4.0
Q	BMWVW-t	MT20	5.0	8.0 2.50 2.00
R	BMV1-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	IN-SX
R	2063	0	0	2063	0	0	5.8	5.8	5.8
J	2063	0	0	2063	0	0	5.8	5.8	5.8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX	MIN	COMPONENT REACTIONS	DEAD	SOIL
R	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	0.0
J	1457	969.0	0.0	0.0	488.0	0.0
J	1457	969.0	0.0	0.0	488.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.78 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX (PLF)	MEMB.	FORCE (LBS)	MAX. UNBRACED LENGTH	FR-TO
A-B	0/28	-91.8	-91.8 0.12 (1)	Q-C	-354.0	10.00	0.08 (1)
B-C	-2834.0	-91.8	-91.8 0.39 (1)	C-P	-210.0	10.00	0.13 (1)
C-D	-2888.0	-91.8	-91.8 0.37 (1)	P-D	0/246	10.00	0.06 (4)
D-E	-3061.0	-91.8	-91.8 0.97 (1)	D-N	0/845	10.00	0.19 (1)
E-F	-3061.0	-91.8	-91.8 0.97 (1)	N-E	-872.0	10.00	0.51 (1)
F-G	-2688.0	-91.8	-91.8 0.37 (1)	L-F	0/845	10.00	0.19 (1)
G-H	-2834.0	-91.8	-91.8 0.39 (1)	L-F	0/246	10.00	0.06 (4)
H-I	0/28	-91.8	-91.8 0.12 (1)	L-G	-210.0	10.00	0.13 (1)
R-B	-2018.0	0.0	0.0 0.20 (1)	K-G	-354.0	10.00	0.08 (1)
J-H	-2018.0	0.0	0.0 0.20 (1)	B-Q	0/2591	10.00	0.58 (1)
R-Q	0/0	-18.5	-18.5 0.10 (4)	K-H	0/2591	10.00	0.58 (1)
Q-P	0/2554	-18.5	-18.5 0.51 (1)				
P-O	0/2388	-18.5	-18.5 0.49 (1)				
O-N	0/2388	-18.5	-18.5 0.49 (1)				
N-M	0/2388	-18.5	-18.5 0.49 (1)				
M-L	0/2388	-18.5	-18.5 0.49 (1)				
L-K	0/2554	-18.5	-18.5 0.51 (1)				
K-J	0/0	-18.5	-18.5 0.10 (4)				

TOTAL WEIGHT = 2 X 139 = 277 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")

CALCULATED VERT. DEFL.(LL) = L/999 (0.17")

ALLOWABLE DEFL.(TL) = L/360 (1.17")

CALCULATED VERT. DEFL.(TL) = L/999 (0.34")

CSI: TC=0.97/1.00 (E-F:1), BC=0.51/1.00 (K-L:1).

WB=0.59/1.00 (H-K:1), SS=0.34/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.87 (D) (INPUT = 0.90)

JSI METAL= 0.82 (M) (INPUT = 1.00)



Structural component only
DWG# T-2006999

JOB NAME 408089	TRUSS NAME T33	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:25:44 2020 Page 1	ID:DMCubINVR6TstFoe31v8f_zns11-VCKCz8zcsFc?xh2kYnL3xTo49JYqADKNMRIUzzNECb

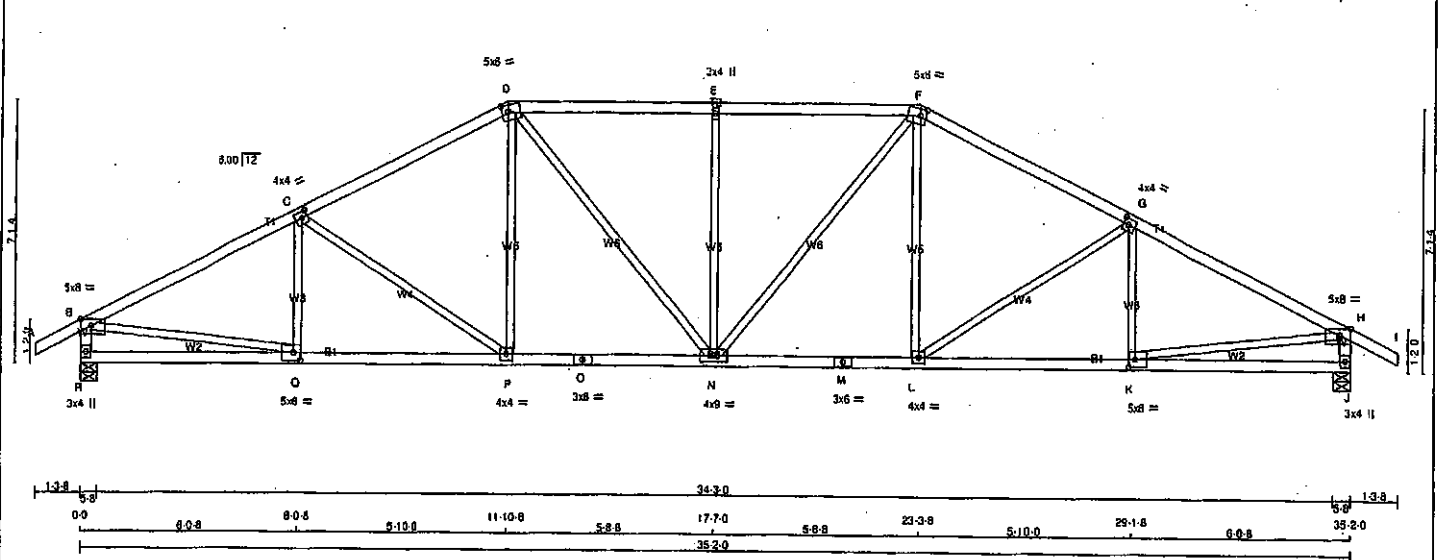

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2
H - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMWV-p	MT20	5.0	8.0 Edge 3.50
C	TMWV-i	MT20	4.0	4.0 2.00 1.75
D	TMWV-m	MT20	5.0	6.0 2.25 2.00
E	TMWV-w	MT20	2.0	4.0
F	TMWV-m	MT20	5.0	6.0 2.25 2.00
G	TMWV-i	MT20	4.0	4.0 2.00 1.75
H	TMWV-p	MT20	5.0	8.0 Edge 3.50
J	BMV1-p	MT20	3.0	4.0
K	BMWV-i	MT20	5.0	6.0 2.50 2.25
L	BMWV-i	MT20	4.0	4.0
M	BS-i	MT20	3.0	6.0
N	BMWVW-i	MT20	4.0	9.0
O	BS-i	MT20	3.0	6.0
P	BMWV-i	MT20	4.0	4.0
Q	BMWVW-i	MT20	5.0	6.0 2.50 2.25
R	BMV1-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
R	2063	0	2063	0	0	5-8	5-8	5-8	5-8
J	2063	0	2063	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX/MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
R	1457	989/0	0/0	0/0	0/0
J	1457	989/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (PLF)	MEMB.	FORCE (LBS)	MAX. (LBS)	MAX. (LBS)
FR-TO				FR-TO			
A-B	0/28	-91.8	-91.8 0.12 (1)	Q-C	-255/12	0.07 (1)	0.07 (1)
B-C	-2889/0	-91.8	-91.8 0.58 (1)	C-P	-435/0	0.42 (1)	0.42 (1)
C-D	-2539/0	-91.8	-91.8 0.52 (1)	P-D	0/350	0.08 (1)	0.08 (1)
D-E	-2559/0	-91.8	-91.8 0.48 (1)	D-N	0/482	0.11 (1)	0.11 (1)
E-F	-2559/0	-91.8	-91.8 0.48 (1)	N-E	-841/0	0.56 (1)	0.56 (1)
F-G	-2539/0	-91.8	-91.8 0.52 (1)	N-F	0/482	0.11 (1)	0.11 (1)
G-H	-2889/0	-91.8	-91.8 0.58 (1)	L-F	0/350	0.08 (1)	0.08 (1)
H-I	0/28	-91.8	-91.8 0.12 (1)	L-G	-435/0	0.42 (1)	0.42 (1)
R-B	-2014/0	0.0	0.0 0.20 (1)	K-G	-255/12	0.07 (1)	0.07 (1)
J-H	-2014/0	0.0	0.0 0.20 (1)	B-Q	0/2835	0.59 (1)	0.59 (1)
R-Q	0/0	-18.5	-18.5 0.15 (4)	K-H	0/2835	0.59 (1)	0.59 (1)
Q-P	0/2809	-18.5	-18.5 0.49 (1)				
P-O	0/2249	-18.5	-18.5 0.43 (1)				
O-N	0/2249	-18.5	-18.5 0.43 (1)				
N-M	0/2249	-18.5	-18.5 0.43 (1)				
M-L	0/2249	-18.5	-18.5 0.43 (1)				
L-K	0/2809	-18.5	-18.5 0.49 (1)				
K-J	0/0	-18.5	-18.5 0.15 (4)				

TOTAL WEIGHT = 2 X 145 = 289 lb (MIF)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")
CSI: TC=0.58/1.00 (G-H:1), BC=0.49/1.00 (K-L:1), WB=0.59/1.00 (H-K:1), SS=0.25/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (K) (INPUT = 0.90)
JSI METAL = 0.69 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007000

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408089	T34	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 6.310 S Oct 29 2019 Metek Industries, Inc. Sat Apr 25 09:25:45 2020 Page 1
ID:DMCubINVR6TstF0g31v8I_zns11-zPuaAT_EdZksZNGEIGlac90wxZeFzdOUc0BC1PzNECa
35 2.0 38 5.8
Scale = 1:500

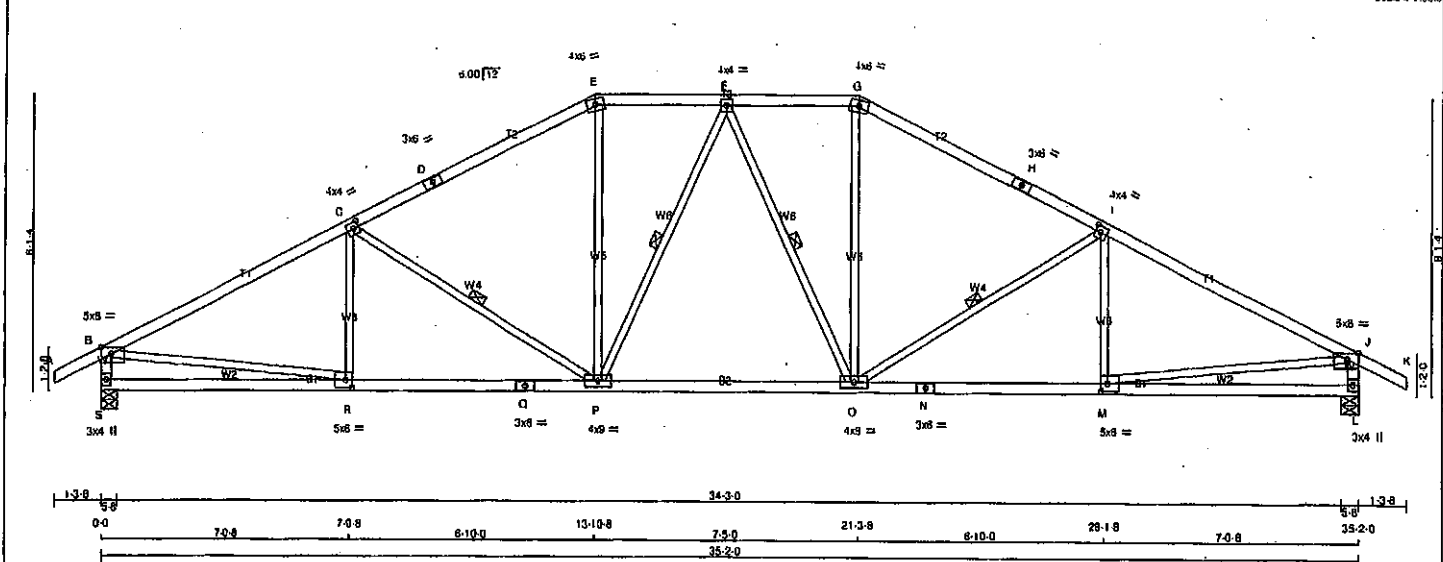

TOTAL WEIGHT = 2 X 145 = 291 lb
(M/F)

N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
E - G	2x4	DRY	No.2
H - K	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - B	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	Edge	3.50
C TMVW-t	MT20	4.0	4.0		2.00 1.75
D TS-1	MT20	3.0	8.0		
E TTVW-m	MT20	4.0	8.0		
F TMVW-t	MT20	4.0	4.0		
G TTVW-m	MT20	4.0	8.0		
H TS-1	MT20	3.0	8.0		
I TMVW-t	MT20	4.0	4.0	2.00	1.75
J TMVW-p	MT20	5.0	8.0	Edge	3.50
L BMV1-p	MT20	3.0	4.0		
M BMVW-t	MT20	5.0	8.0	2.50	2.25
N SS-t	MT20	3.0	8.0		
O BMVW-t	MT20	4.0	9.0		
P BMVW-t	MT20	4.0	9.0		
Q SS-t	MT20	3.0	8.0		
R BMVW-t	MT20	5.0	8.0	2.50	2.25
S BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
S	2083	0	0	2083	0	0	5-8	5-8	5-8
L	2083	0	0	2083	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
S	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	
L	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-P, F-P, F-O, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH FR-TO (LC)
FR-TO			
A-B	0 / 28	-91.8 -91.8 0.12 (1)	10.00
B-C	-2908 / 0	-91.8 -91.8 0.83 (1)	3.25
C-D	-2373 / 0	-91.8 -91.8 0.72 (1)	3.66
D-E	-2373 / 0	-91.8 -91.8 0.72 (1)	3.66
E-F	-2100 / 0	-91.8 -91.8 0.19 (1)	4.53
F-G	-2100 / 0	-91.8 -91.8 0.19 (1)	4.53
G-H	-2373 / 0	-91.8 -91.8 0.72 (1)	3.66
H-I	-2373 / 0	-91.8 -91.8 0.72 (1)	3.66
I-J	-2908 / 0	-91.8 -91.8 0.83 (1)	3.25
J-K	0 / 28	-91.8 -91.8 0.12 (1)	10.00
S-B	-2008 / 0	0.0 0.0 0.20 (1)	5.96
L-J	-2008 / 0	0.0 0.0 0.20 (1)	5.96
S-R	0 / 0	-18.5 -18.5 0.20 (4)	10.00
R-Q	0 / 2630	-18.5 -18.5 0.52 (1)	10.00
Q-P	0 / 2630	-18.5 -18.5 0.52 (1)	10.00
P-O	0 / 2193	-18.5 -18.5 0.45 (1)	10.00
O-N	0 / 2630	-18.5 -18.5 0.52 (1)	10.00
N-M	0 / 2630	-18.5 -18.5 0.52 (1)	10.00
M-L	0 / 0	-18.5 -18.5 0.20 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CSI: TC=0.83/1.00 (B-C:1), BC=0.52/1.00 (M-O:1), WB=0.60/1.00 (B-R:1), SSI=0.28/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(P.S.I) (P.L.I) (P.L.I)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.88 (M) (INPUT = 0.90)
JSI METAL= 0.79 (O) (INPUT = 1.00)




Structural component only
DWG# T-2007001

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408089	T35	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:25:47 2020 Page 1
 ID:DMCubINVR6TstFoe31v6L_zns1l-vn0Lb97U9A_achQdPgK2ha5MBMJ61Xgn3KgJ5i2NECY

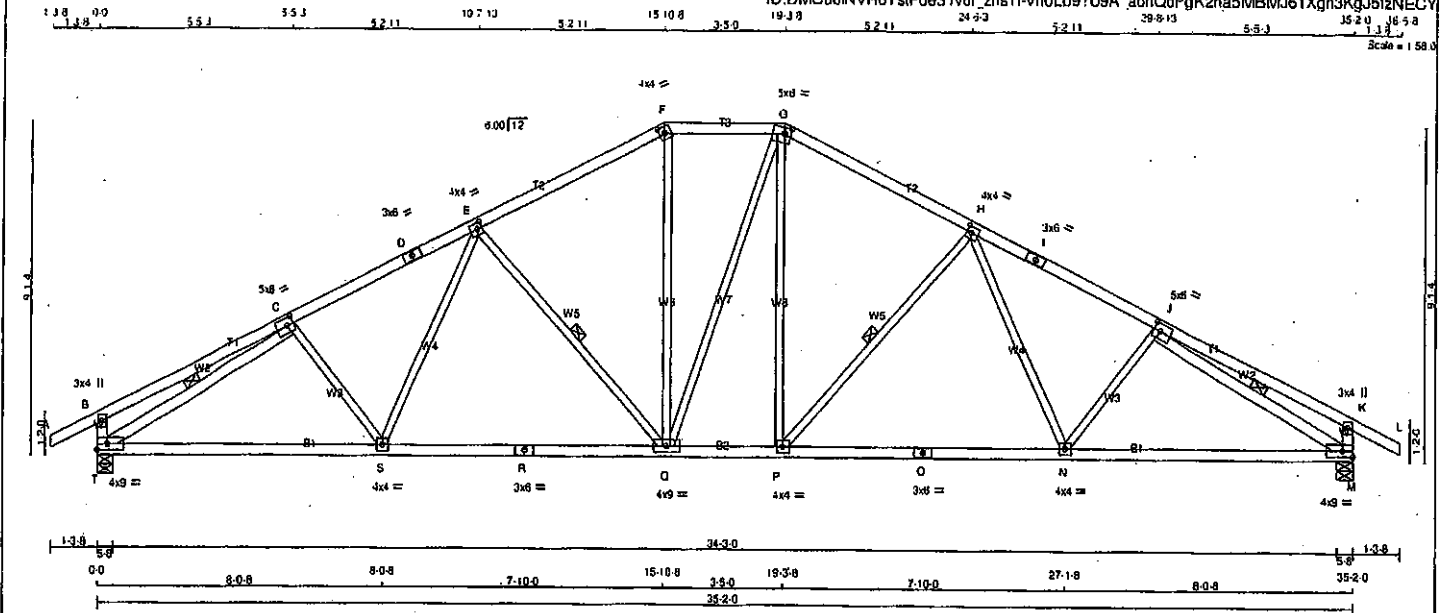

TOTAL WEIGHT = 2 X 155 = 310 lb
 (MIP)

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
T - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
T - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
T - C	2x4	DRY	No.2
J - M	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV-p	MT20	3.0	4.0
C	TMWW-i	MT20	5.0	6.0 2.50 2.25
D	TS-i	MT20	3.0	6.0
E	TMWW-i	MT20	4.0	4.0 2.00 1.50
F	TTW-h	MT20	4.0	4.0 2.00 1.75
G	TTWW-m	MT20	5.0	6.0 2.00 2.00
H	TMWW-i	MT20	4.0	4.0 2.00 1.50
I	TS-i	MT20	3.0	6.0
J	TMWW-i	MT20	5.0	6.0 2.50 2.25
K	TMV-p	MT20	3.0	4.0
M	BMVW-i	MT20	4.0	9.0 Edge
N, P, S				
N	BMWW-i	MT20	4.0	4.0
O	BS-i	MT20	3.0	6.0
Q	BMWW-i	MT20	4.0	9.0
R	BS-i	MT20	3.0	6.0
T	BMVW-i	MT20	4.0	9.0 Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
T	2063	0	2063	0	0
M	2063	0	2063	0	0

UNFACTORED REACTIONS						
	1ST LOASE	MAX. MIN.	COMPONENT REACTIONS			
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
T	1457	999 / 0	0 / 0	0 / 0	0 / 0	488 / 0
M	1457	999 / 0	0 / 0	0 / 0	0 / 0	488 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT (S) T, M

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, H-P, G-T, J-M

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING			
TOTAL LOAD CASES: (4)			
CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
FR-TO		FROM TO	
A-B	0 / 28	-91.8 -91.8 0.12 (1)	10.00
B-C	0 / 20	-91.8 -91.8 0.32 (1)	10.00
C-D	-2760 / 0	-91.8 -91.8 0.40 (1)	3.88
D-E	-2760 / 0	-91.8 -91.8 0.40 (1)	3.88
E-F	-2167 / 0	-91.8 -91.8 0.36 (1)	4.30
F-G	-1925 / 0	-91.8 -91.8 0.18 (1)	4.71
G-H	-2165 / 0	-91.8 -91.8 0.36 (1)	4.30
H-I	-2761 / 0	-91.8 -91.8 0.40 (1)	3.88
I-J	-2761 / 0	-91.8 -91.8 0.40 (1)	3.88
J-K	0 / 20	-91.8 -91.8 0.32 (1)	10.00
K-L	0 / 28	-91.8 -91.8 0.12 (1)	10.00
T-B	-325 / 0	0.0 0.0 0.03 (1)	7.81
M-K	-325 / 0	0.0 0.0 0.03 (1)	7.81
T-S	0 / 2538	-18.5 -18.5 0.56 (1)	10.00
S-R	0 / 2362	-18.5 -18.5 0.53 (1)	10.00
R-Q	0 / 2362	-18.5 -18.5 0.53 (1)	10.00
Q-P	0 / 1924	-18.5 -18.5 0.40 (1)	10.00
P-O	0 / 2362	-18.5 -18.5 0.53 (1)	10.00
O-N	0 / 2362	-18.5 -18.5 0.53 (1)	10.00
N-M	0 / 2538	-18.5 -18.5 0.56 (1)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 OL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 OL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, OBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = 1/999 (0.14")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = 1/999 (0.29")

CSI: TC=0.40/1.00 (H-J:1), BC=0.56/1.00 (M-N:1), WB=0.51/1.00 (J-M:1), SS=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (F) (INPUT = 0.90)
 JSI METAL = 0.83 (O) (INPUT = 1.00)



Structural component only
 DWG# T-2007002

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408089	T36	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 28 2019 Mtek Industries, Inc. Sat Apr 25 09:25:48 2020 Page 1
ID:DMCubINVR6TsFqe31v6l_zns11-O_apV07wU6RQr7pzOrHDneWRmfsmyAwI_PsdKzNECX
J5-20 3639
Scale = 1/8" = 1'-0"

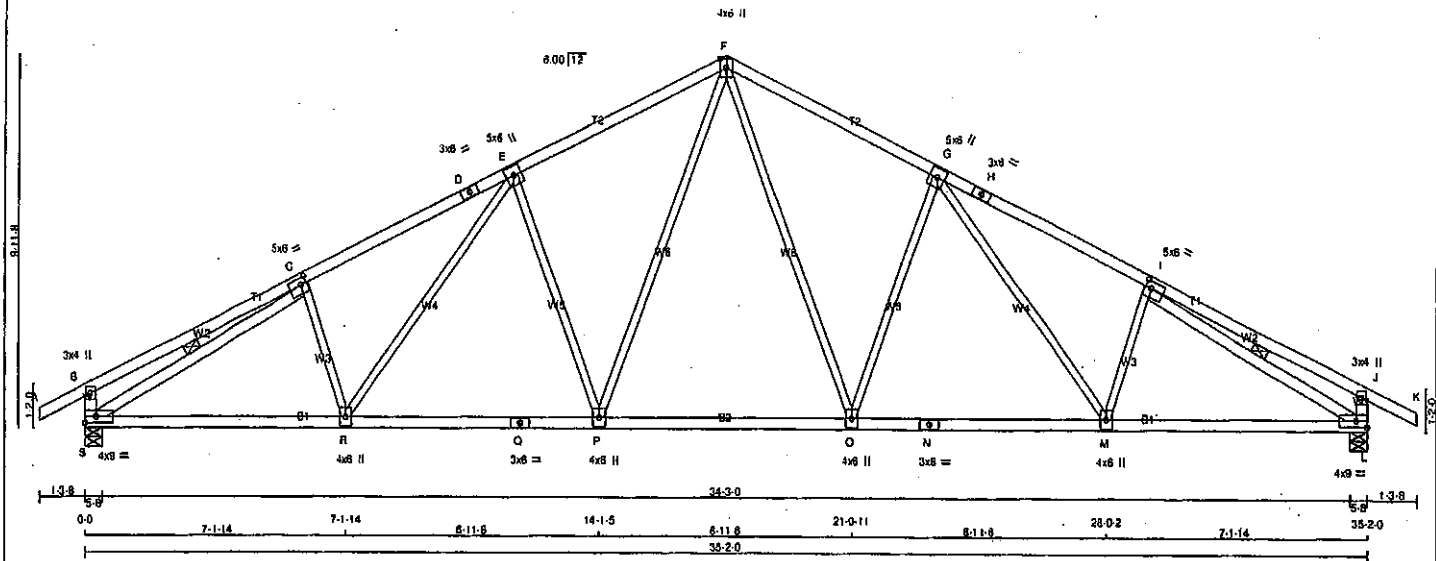

TOTAL WEIGHT = 3 X 152 = 455 lb
(MPF)

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
C	TMVW-1	MT20	5.0	6.0 2.25 2.00
D	TS-1	MT20	3.0	6.0
E	TMVW+1	MT20	5.0	6.0
F	TMVW+p	MT20	4.0	6.0 Edge
G	TMVW+1	MT20	5.0	6.0
H	TS-1	MT20	3.0	6.0
I	TMVW-1	MT20	5.0	6.0 2.25 2.00
J	TMV+p	MT20	3.0	4.0
L	BMVW-1	MT20	4.0	9.0 Edge
M, O, P, R				
M	BMVW-1	MT20	4.0	6.0
N	BS-1	MT20	3.0	6.0
Q	BS-1	MT20	3.0	6.0
S	BMVW-1	MT20	4.0	9.0 Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	BRG	UPLIFT	BRG	IN-SX
S	2063	0	2063	0	0	5-8	5-8	5-8	5-8
L	2063	0	2063	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.
1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, I-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-91.8 -91.8	0.12 (1)	10.00	F-O	0 / 868	0.19 (1)
B-C	0 / 22	-91.8 -91.8	0.40 (1)	10.00	O-G	-728 / 0	0.72 (1)
C-D	-2808 / 0	-91.8 -91.8	0.49 (1)	3.75	G-M	0 / 391	0.09 (1)
D-E	-2808 / 0	-91.8 -91.8	0.49 (1)	3.75	M-I	-192 / 18	0.05 (1)
E-F	-2322 / 0	-91.8 -91.8	0.46 (1)	4.07	P-F	0 / 868	0.19 (1)
F-G	-2322 / 0	-91.8 -91.8	0.46 (1)	4.07	E-P	-728 / 0	0.72 (1)
G-H	-2808 / 0	-91.8 -91.8	0.49 (1)	3.75	R-E	0 / 391	0.09 (1)
H-I	-2808 / 0	-91.8 -91.8	0.49 (1)	3.75	C-R	-192 / 18	0.05 (1)
I-J	0 / 22	-91.8 -91.8	0.40 (1)	10.00	S-C	-3064 / 0	0.72 (1)
J-K	0 / 28	-91.8 -91.8	0.12 (1)	10.00	I-L	-3064 / 0	0.72 (1)
S-B	-344 / 0	0.0 0.0	0.03 (1)	7.81			
L-J	-344 / 0	0.0 0.0	0.03 (1)	7.81			
S-R	0 / 2574	-18.5 -18.5	0.53 (1)	10.00			
R-Q	0 / 2291	-18.5 -18.5	0.47 (1)	10.00			
Q-P	0 / 2291	-18.5 -18.5	0.47 (1)	10.00			
P-O	0 / 1782	-18.5 -18.5	0.38 (1)	10.00			
O-N	0 / 2291	-18.5 -18.5	0.47 (1)	10.00			
N-M	0 / 2291	-18.5 -18.5	0.47 (1)	10.00			
M-L	0 / 2574	-18.5 -18.5	0.53 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = 1/899 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = 1/899 (0.28")

CSI: TC=0.49/1.00 (G-I:1), BC=0.53/1.00 (L-M:1), WB=0.72/1.00 (G-O:1), SSI=0.22/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (1) (INPUT = 0.80)
JSI METAL= 0.77 (1) (INPUT = 1.00)

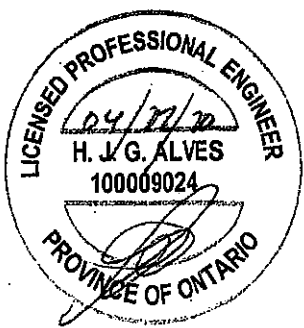

Structural component only
DWG# T-2007003

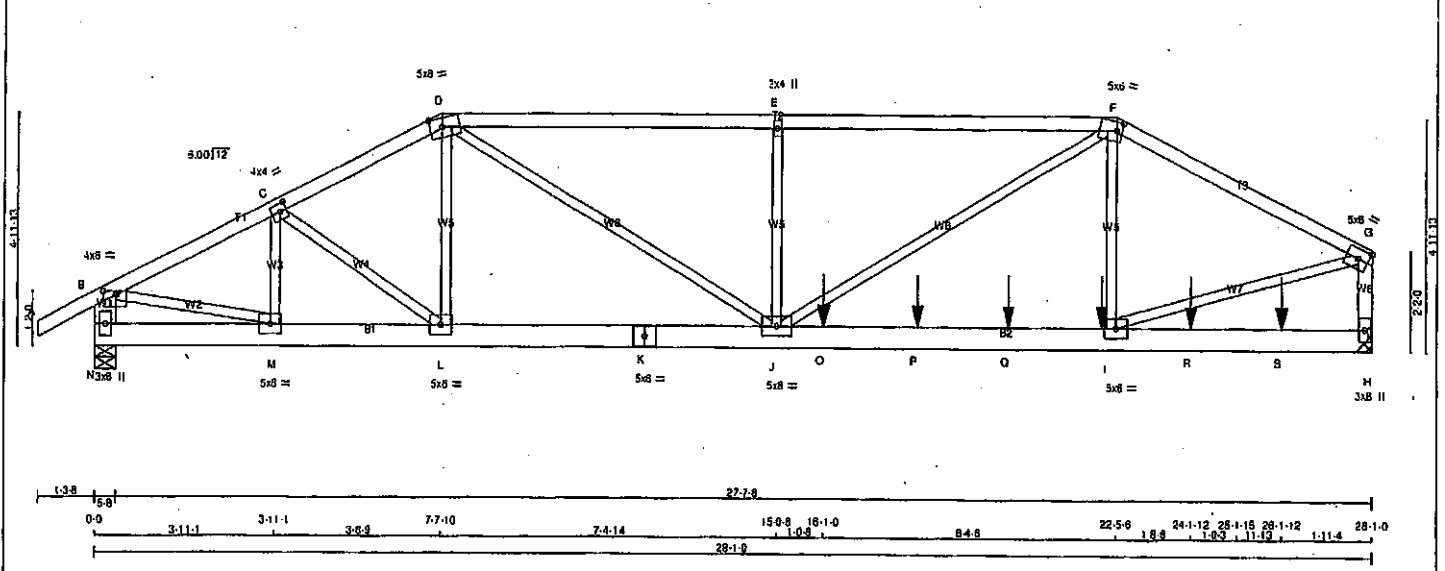

LUMBER				
N. L. C. A. RULES				
CHORDS	SIZE		LUMBER	DESCR
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
N - B	2x6	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF
N - K	2x6	DRY	No.2	SPF
K - H	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-D 1	12	TOP
D-F 1	12	TOP
F-G 1	12	TOP
H-G 1	12	TOP
N-B 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
N-K 2	12	TOP
K-H 2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQ'D BRG
JT	VERT	DOWN	0	0
N	2368	0	0	0
H	2951	0	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 4'-0".

UNFACTORED REACTIONS

1ST LOASE	MAX/MIN. COMPONENT REACTIONS
JT COMBINED	SNOW
N	1669
H	2078

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.70 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
FR-TO	MAX. FORCE (LBS)	VERT. LOAD LC1 MAX. (PLF)	FR-TO	MAX. FORCE (LBS)
A-B	0/28	-91.8	M-C	-537/0
B-C	-3250/0	-91.8	C-L	0/112
C-D	-3386/0	-91.8	L-D	-35/73
D-E	-4857/0	-91.8	D-J	0/2173
E-F	-4857/0	-91.8	J-E	-827/0
F-G	-3557/0	-91.8	J-F	0/1975
N-B	-2308/0	0.0	F-F	0/79
H-G	-2836/0	0.0	G-G	0/3328
N-M	0/0	-18.5	B-M	0/2977
M-L	0/2921	-18.5		
L-K	0/3011	-18.5		
K-J	0/3011	-18.5		
J-O	0/3180	-18.5		
O-P	0/3180	-18.5		
P-Q	0/3180	-18.5		
Q-I	0/3180	-18.5		
I-R	0/0	-18.5		
R-S	0/0	-18.5		
S-H	0/0	-18.5		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
I	22-1-12	-187	-187	---	FRONT	VERT	TOTAL	C1
O	18-1-0	-1167	-1167	---	FRONT	VERT	TOTAL	C1
P	18-1-12	-187	-187	---	FRONT	VERT	TOTAL	C1
Q	20-1-12	-187	-187	---	FRONT	VERT	TOTAL	C1
R	24-1-12	-198	-198	---	FRONT	VERT	TOTAL	C1
S	26-1-12	-173	-173	---	FRONT	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

11 C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT. CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN PLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.94")

CALCULATED VERT. DEFL.(LL) = L/999 (0.13")

ALLOWABLE DEFL.(TL) = L/380 (0.94")

CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.79/1.00 (D-E:1), BC=0.48/1.00 (I-J:1), WB=0.41/1.00 (G-I:1), SS=0.40/1.00 (H-J:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (F) (INPUT = 0.90)

JSI METAL= 0.45 (G) (INPUT = 1.00)

CONTINUED ON PAGE 2

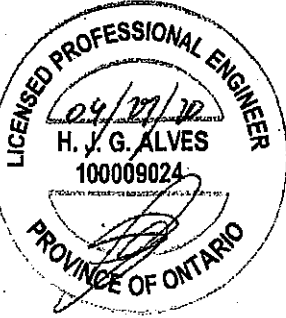

Structural component only
DWG# T-2007004 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408089	T37	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	


Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 09:25:49 2020 Page 2

ID:DMCubINVR6TstFos31v6I_zns1l-sA850r1lhoEI2?a7X5NWm?Ad5A0pVUH3Xs9QAAzNECW


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	6.0	1.00	3.25
C	TMWW-l	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	8.0	2.25	3.25
E	TMW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	8.0	2.25	1.50
G	TMWW-l	MT20	5.0	8.0		Edge
H	BMVl+p	MT20	3.0	6.0		
L, L, M						
I	BMWW-l	MT20	5.0	6.0		
J	BMWWW-l	MT20	5.0	8.0		
K	BS-l	MT20	5.0	6.0		
N	BMVl+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

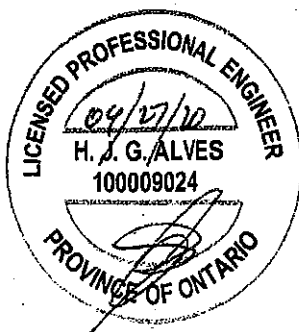

Structural component only
DWG# T-2007004 2/2

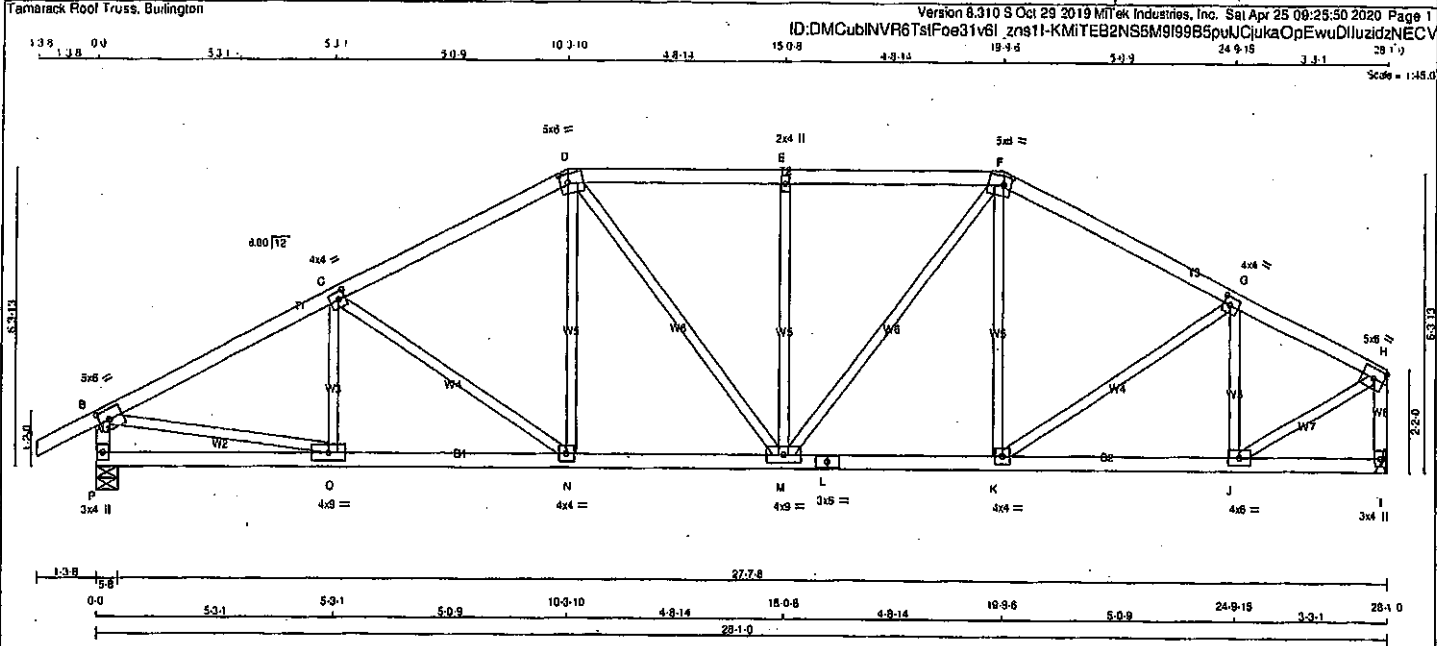

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
J - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - I	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

<u>PLATES (table in inches)</u>						
JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	5.0	8.0	2.50	2.75
B	TMVW-1	MT20	4.0	4.0	2.00	1.75
C	TTVW-m	MT20	5.0	8.0	2.25	2.00
E	TMVW-w	MT20	2.0	4.0		
F	TTVW-m	MT20	5.0	8.0	2.25	2.00
G	TMVW-1	MT20	4.0	4.0	2.00	1.75
H	TMVW-1	MT20	5.0	8.0		Edge
I	BMV1+p	MT20	3.0	4.0		
J	BMVW-1	MT20	4.0	8.0		
K	BMVW-1	MT20	4.0	4.0		
L	BS-1	MT20	3.0	5.0		
M	BMVW-1	MT20	4.0	9.0		
N	BMVW-1	MT20	4.0	4.0		
O	BMVW-1	MT20	4.0	9.0		
P	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	1673	0	0
JT HORZ	1548	0	0
P VERT	1673	0	0
P HORZ	1548	0	0
I VERT	1673	0	0
I HORZ	1548	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3'-8".

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN COMPONENT REACTIONS
JT COMBINED	1161
JT SNOW	788 / 0
JT LIVE	0 / 0
JT PERM.LIVE	0 / 0
JT WIND	393 / 0
JT DEAD	376 / 0
JT SOIL	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.
FR-TO				FR-TO			
A-B	0 / 28	-91.8	10.00	C-C	-224 / 10	0.05 (1)	
B-C	-2197 / 0	-91.8	4.25	C-N	-370 / 0	0.25 (1)	
C-D	-1905 / 0	-91.8	4.59	N-D	0 / 303	0.07 (1)	
D-E	-1838 / 0	-91.8	4.66	D-M	0 / 247	0.08 (1)	
E-F	-1838 / 0	-91.8	4.66	M-E	-530 / 0	0.34 (1)	
F-G	-1711 / 0	-91.8	4.79	M-F	0 / 527	0.12 (1)	
G-H	-1474 / 0	-91.8	5.14	K-F	-15 / 63	0.02 (4)	
P-B	-1629 / 0	0.0	6.40	K-G	0 / 202	0.05 (1)	
I-H	-1524 / 0	0.0	8.85	J-G	-687 / 0	0.18 (1)	
				B-O	0 / 2012	0.45 (1)	
				J-H	0 / 1548	0.35 (1)	
P-O	0 / 0	-18.5	10.00				
O-N	0 / 1986	-18.5	10.00				
N-M	0 / 1685	-18.5	10.00				
M-L	0 / 1512	-18.5	10.00				
L-K	0 / 1512	-18.5	10.00				
K-J	0 / 1345	-18.5	10.00				
J-I	0 / 0	-18.5	10.00				

TOTAL WEIGHT = 119 lb

(M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 066-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.94")

CALCULATED VERT. DEFL.(LL) = L/999 (0.08")

ALLOWABLE DEFL.(TL) = L/360 (0.94")

CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TO=0.38/1.00 (B-C:1), BC=0.37/1.00 (N-O:1), WS=0.45/1.00 (B-O:1), SS=0.21/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 818 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (J) (INPUT = 0.80)

JSI METAL = 0.59 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007005

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408089	T39	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Sat Apr 25 09:25:51 2020 Page 1
ID:DMCubINVR6TsiFoe31v6I zns11-oZGrRX2?DPU0HkOeWP rQGylzlvzL6M yeXE3zNEC9

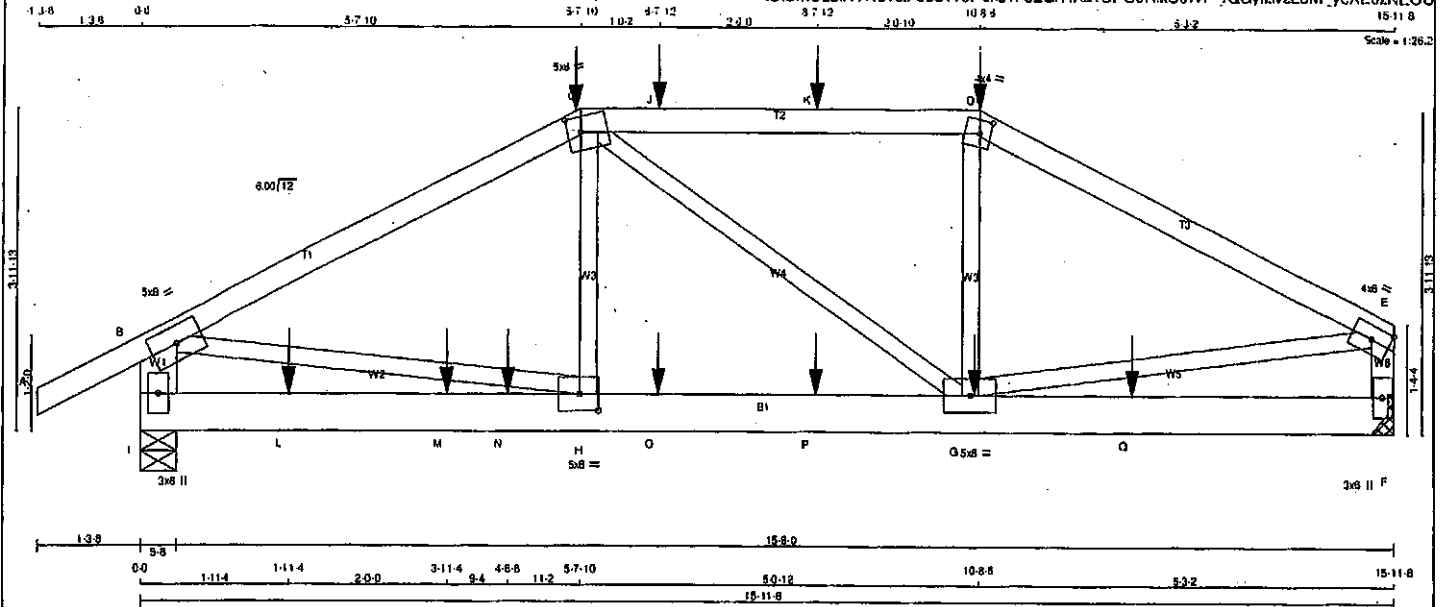

TOTAL WEIGHT = 70 lb
[M]

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	5.0	8.0	
C	TTWW-m	MT20	5.0	8.0	2.25 2.00
D	TTW-m	MT20	4.0	4.0	2.00 1.75
E	TMVW-t	MT20	4.0	8.0	Edge
F	BMV1-p	MT20	3.0	6.0	
G	BMVWW-1	MT20	5.0	8.0	
H	BMVWW-1	MT20	5.0	6.0	2.50 2.75
I	BMV1-p	MT20	3.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT RECD
I	1850 0	1850 0	5.8 5.8
F	1408 0	1408 0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3-8.

UNFACTORED REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
I	1315	854 / 0	0 / 0	0 / 0	0 / 0	481 / 0
F	995	560 / 0	0 / 0	0 / 0	0 / 0	334 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.56 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO		FROM	TO
A-B	0 / 28	-91.8	-91.8 0.13 (1)
B-C	-2319 / 0	-91.8	-91.8 0.77 (1)
C-J	-1831 / 0	-91.8	-91.8 0.54 (1)
J-K	-1831 / 0	-91.8	-91.8 0.54 (1)
K-D	-1831 / 0	-91.8	-91.8 0.54 (1)
D-E	-1821 / 0	-91.8	-91.8 0.60 (1)
E-F	-1703 / 0	0.0	0.0 0.12 (1)
F-G	-1345 / 0	0.0	0.0 0.15 (1)
I-L	0 / 0	-18.5	-18.5 0.34 (1)
L-M	0 / 0	-18.5	-18.5 0.34 (1)
M-N	0 / 0	-18.5	-18.5 0.34 (1)
N-H	0 / 0	-18.5	-18.5 0.34 (1)
H-O	0 / 2091	-18.5	-18.5 0.51 (1)
O-P	0 / 2091	-18.5	-18.5 0.51 (1)
P-Q	0 / 2091	-18.5	-18.5 0.51 (1)
Q-R	0 / 0	-18.5	-18.5 0.08 (4)
R-F	0 / 0	-18.5	-18.5 0.08 (4)

FACTORED CONCENTRATED LOADS (LBS)			
JT	LOC.	LC1	MAX+ MAX-
C	5-7-10	-43	-48
C	5-7-10	-218	-218
D	10-8-6	-43	-48
D	10-8-6	-17	-17
D	10-8-6	-218	-218
G	10-7-12	-2	-2
J	6-7-12	-10	-10
K	8-7-12	-10	-10
L	1-11-4	-17	-17
M	3-11-4	-17	-17
N	4-8-8	-784	-784
O	6-7-12	-2	-2
P	8-7-12	-2	-2
Q	12-7-12	-2	-2

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.53")
CALCULATED VERT. DEFL. (LL) = L/999 (0.08")
ALLOWABLE DEFL. (TL) = L/360 (0.53")
CALCULATED VERT. DEFL. (TL) = L/999 (0.12")

CSI: TC=0.77/1.00 (B-C:1), BC=0.51/1.00 (G-H:1),
WB=0.52/1.00 (B-H:1), SSI=0.51/1.00 (H-I:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.88 (E) (INPUT = 0.90)
JSI METAL = 0.52 (H) (INPUT = 1.00)

CONTINUED ON PAGE 2

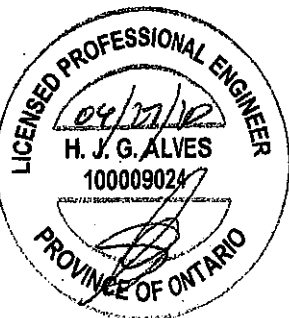

Structural component only
DWG# T-2007006 1/2

JOB NAME 408089	TRUSS NAME T40	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

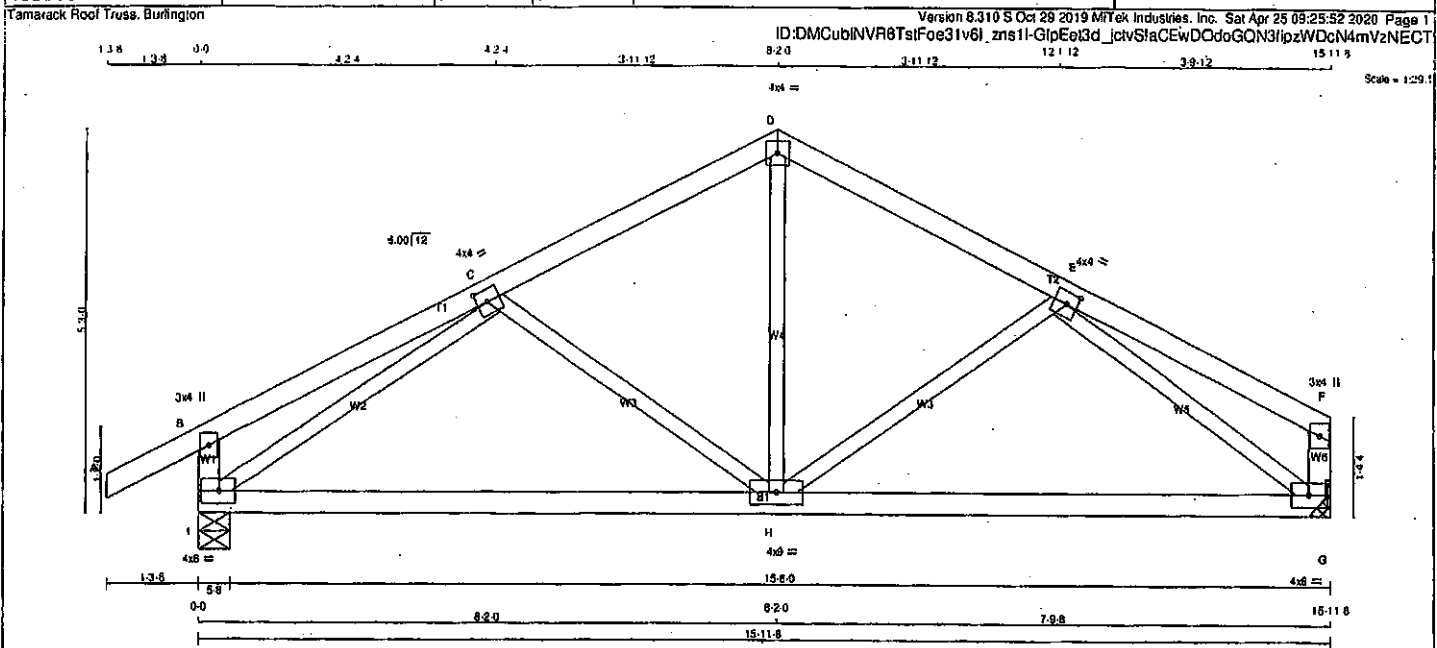

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
I - B	2x4	DRY	No.2
G - F	2x4	DRY	No.2
I - G	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SRF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	4.0	2.00	1.75
D	TTW-p	MT20	4.0	4.0		
E	TMWW-t	MT20	4.0	4.0	2.00	1.75
F	TMV+p	MT20	3.0	4.0		
G	BMVV1-t	MT20	4.0	6.0		
H	BMWWV-t	MT20	4.0	6.0		
I	BMVV1-t	MT20	4.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT 1004	0	0	5-8
I	HORZ 880	0	0	5-8
G	DOWN 880	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
I	708	478/0	0/0	0/0	0/0	230/0	0/0
G	622	408/0	0/0	0/0	0/0	214/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PL)	MAX. FACTORED UNBRACED LENGTH (L)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (L)	CS (L)
FR-TO				FR-TO			
A-B	0/28	-91.8	0.12 (1)	10.00	C-H	-263/0	0.11 (1)
B-C	0/19	-91.8	0.24 (1)	10.00	H-D	0/445	0.10 (1)
C-D	-844/0	-91.8	0.19 (1)	8.25	H-E	-190/0	0.08 (1)
D-E	-842/0	-91.8	0.17 (1)	8.25	I-C	-1167/0	0.48 (1)
E-F	0/19	-91.8	0.22 (1)	10.00	E-G	-1132/0	0.41 (1)
F-B	-270/0	0.0	0.03 (1)	7.81			
G-F	-129/0	0.0	0.01 (1)	7.81			
I-H	0/952	-18.5	-18.5	0.41 (4)	10.00		
H-G	0/892	-18.5	-18.5	0.41 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 8 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.53")

CALCULATED VERT. DEFL.(LL) = L/999 (0.02")

ALLOWABLE DEFL.(TL) = L/360 (0.53")

CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.24/1.00 (B-C:1), BC=0.41/1.00 (H-I:4), WB=0.48/1.00 (C-I:1), SS=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP (DRY)	SHEAR (PS)	SECTION (PL)
MT20	618	354	1687
	788	1997	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.83 (E) (INPUT = 0.90)

JSI METAL = 0.39 (C) (INPUT = 1.00)

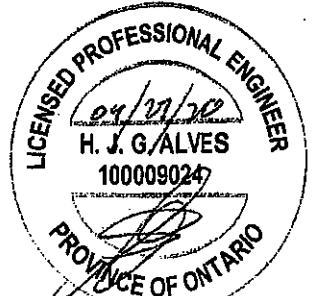


Structural component only
DWG# T-2007007

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408089	T41	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:25:54 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-C8x_3Y51VKsa8mSzKfytT2uSsBn7AmnpgwsBrOzNECR

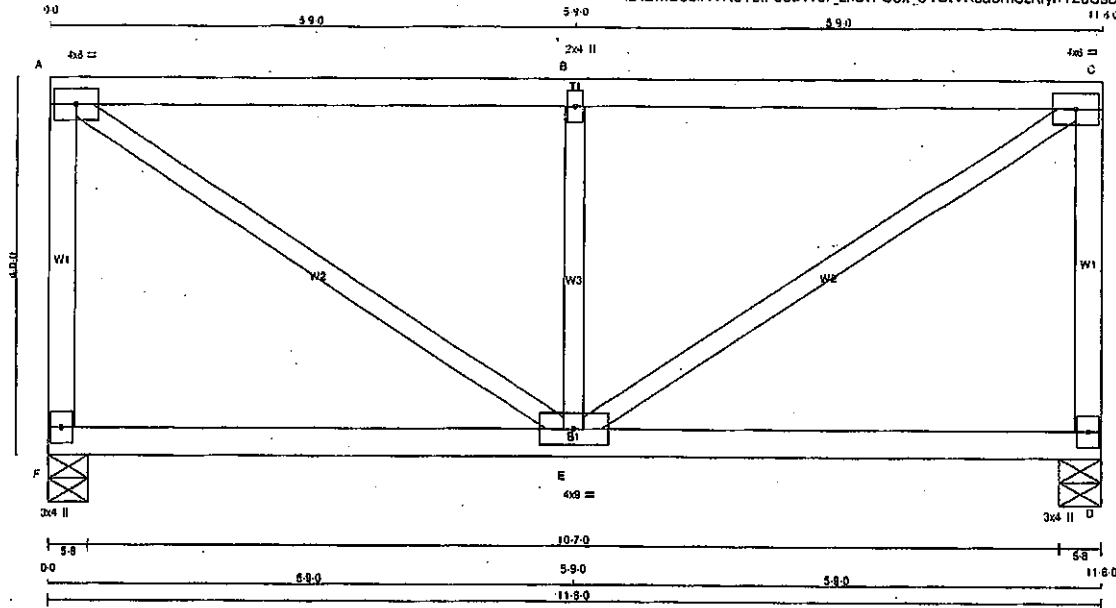

TOTAL WEIGHT = 3 X 47 = 141 lb
(MTR)

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
F - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ORY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMW-I	MT20	4.0	8.0	
B	TMW-w	MT20	2.0	4.0	
C	TMW-I	MT20	4.0	8.0	
D	BMV1+p	MT20	3.0	4.0	
E	BMWVW-I	MT20	4.0	9.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING.

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	783	0	783	0
D	783	0	783	0

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
F	COMBINED	SNOW	LIVE	PERM. LIVE	
D	552	294 / 0	0 / 0	0 / 0	258 / 0
	552	294 / 0	0 / 0	0 / 0	258 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.30 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
F-A	-721 / 0	0.0	0.0 0.24 (1)	A-E	0 / 870	0.26 (1)	
A-B	-731 / 0	-114.3	-114.3 0.88 (1)	E-B	-815 / 0	0.27 (1)	
B-C	-731 / 0	-114.3	-114.3 0.88 (1)	E-C	0 / 870	0.26 (1)	
D-C	-721 / 0	0.0	0.0 0.24 (1)				
F-E	0 / 0	-18.5	-18.5 0.22 (4)				
E-D	0 / 0	-18.5	-18.5 0.22 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.8 PSF
DL	= 15.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 48.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.38")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.38")
CALCULATED VERT. DEFL. (TL) = L/999 (0.04")

CSI: TC=0.88/1.00 (B-C:1), BC=0.22/1.00 (E-F:4),
WB=0.27/1.00 (B-E:1), SS=0.42/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788	1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (A) (INPUT = 0.90)
JSI METAL = 0.27 (C) (INPUT = 1.00)

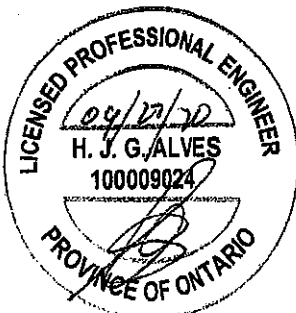


Structural component only
DWG# T-2007008

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408089	G41	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:25:34 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-ohkQqKDBLQkhW79Sb?fq3DU7?WUms4p078YzNEC

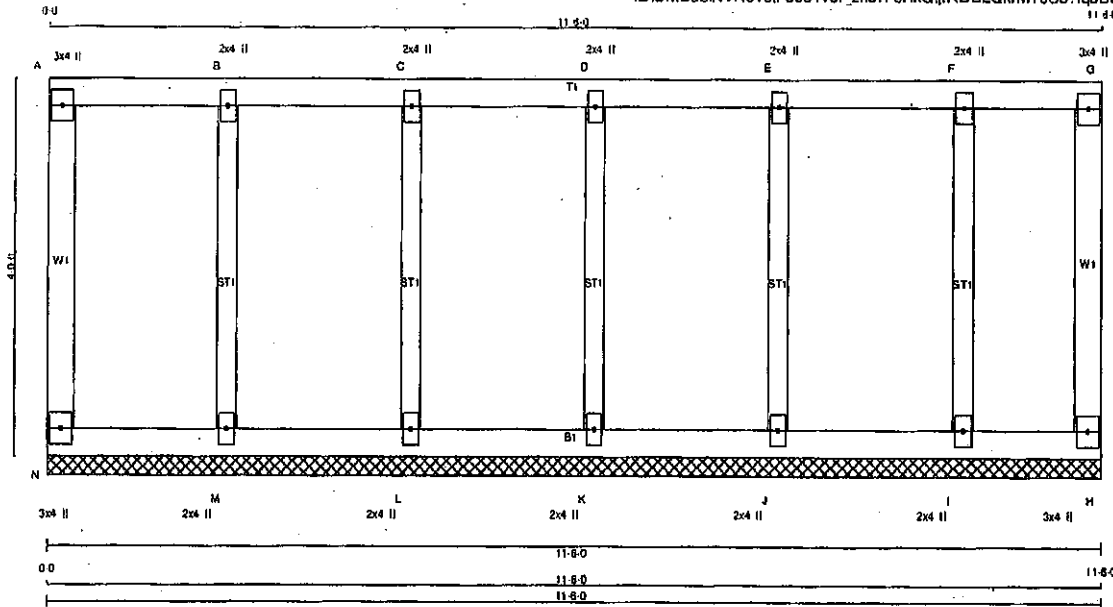

Scale = 1/22.5

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
N - A	2x4	DRY	No.2
A - G	2x4	DRY	No.2
H - G	2x4	DRY	No.2
N - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			
GABLE STUDS SPACED AT 2-0-0 OC.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMV+p	MT20	3.0	4.0
B, C, D, E, F				
B	TMW+w	MT20	2.0	4.0
G	TMV+p	MT20	3.0	4.0
H	BMV1+p	MT20	3.0	4.0
I, J, K, L, M				
I	BMW1+w	MT20	2.0	4.0
N	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING.

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
N-A	-100 / 0	0.0 0.0 0.03 (1)	7.81	M-B	-244 / 0	0.08 (1)	
A-B	-5 / 0	-114.3 -114.3 0.08 (1)	10.00	L-C	-228 / 0	0.07 (1)	
B-C	-5 / 0	-114.3 -114.3 0.08 (1)	10.00	K-D	-228 / 0	0.07 (1)	
C-D	-5 / 0	-114.3 -114.3 0.07 (1)	10.00	J-E	-234 / 0	0.08 (1)	
D-E	-5 / 0	-114.3 -114.3 0.07 (1)	10.00	I-F	-207 / 0	0.07 (1)	
E-F	-5 / 0	-114.3 -114.3 0.07 (1)	10.00				
F-G	-5 / 0	-114.3 -114.3 0.05 (1)	10.00				
H-G	-74 / 0	0.0 0.0 0.02 (1)	7.81				
N-M	0 / 5	-18.5 -18.5 0.02 (4)	10.00				
M-L	0 / 5	-18.5 -18.5 0.02 (4)	10.00				
L-K	0 / 5	-18.5 -18.5 0.02 (4)	10.00				
K-J	0 / 5	-18.5 -18.5 0.02 (4)	10.00				
J-I	0 / 5	-18.5 -18.5 0.02 (4)	10.00				
I-H	0 / 5	-18.5 -18.5 0.02 (4)	10.00				

TOTAL WEIGHT = 48 lb (M/R)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 15.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 48.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC02010, NBC02015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019

- PART 9 OF OBC 2012 (2019 AMENDMENT)

- CSA 086-00, CSA 086-14

- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.08/1.00 (B-C:1), 8C=0.02/1.00 (M-N:4), WB=0.08/1.00 (B-M:1), 6SI=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.17 (M) (INPUT = 0.90)
JSI METAL= 0.07 (M) (INPUT = 1.00)

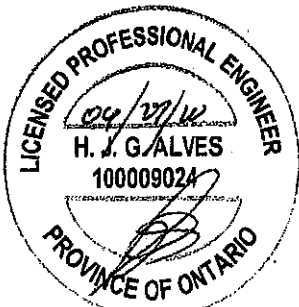

Structural component only
DWG# T-2006992

JOB NAME 408089	TRUSS NAME T43S	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 09:25:35 2020 Page 1
ID:DMCubINVRH6TsiFoe31v6I_zns11-qKVMHu6WGe_Rmw19MTw0GQoAbAAvHfyvackNqzNECO

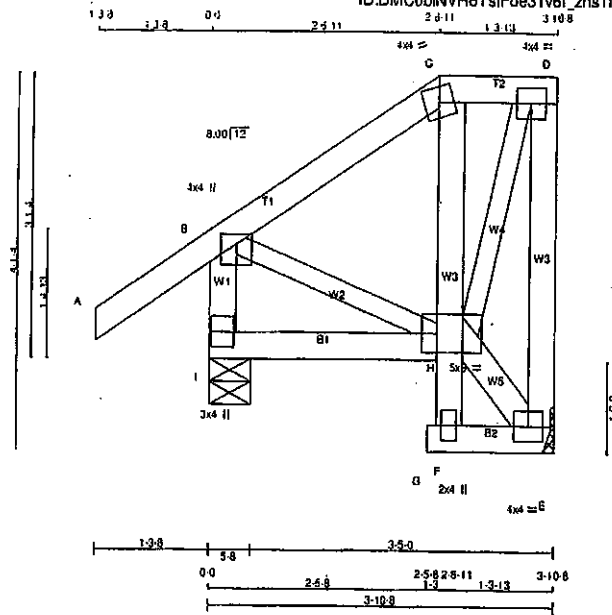

Scale = 1/2" = 1'-0"

TOTAL WEIGHT = 26 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
I - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
G - E	2x4	DRY	No.2
ALL WEBS 2x4 DRY No.2			
EXCEPT			
H - D	2x3	DRY	No.2
B - H	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW+P	MT20	4.0	4.0	1.25	2.00
C	TMW-m	MT20	4.0	4.0		
D	TMW-4	MT20	4.0	4.0		
E	BMW1-1	MT20	4.0	4.0		
F	BMW+P	MT20	2.0	4.0		
H	BMW+WW+J	MT20	5.0	8.0	2.50	2.00
I	BMV1+P	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	DOWN	HORZ	IN-SX	BRG	IN-SX	BRG
E	216	0	216	0	0	MECHANICAL			
I	341	0	341	0	0	5-8		5-8	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN.	COMPONENT REACTIONS						
			SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
E	153	99.0	0.0	0.0	0.0	0.0	54.0	0.0	
I	239	189.0	0.0	0.0	0.0	0.0	69.0	0.0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

MAX. UNBRACED INTERIOR CHORD LENGTH = 7.81 FT

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH FR-TO	MEMB.	FORCE (LBS)	MAX. CS1 (LC)
A-B	0.735	-91.8	-91.8 0.14 (5)	10.00	H-E	-10.0	0.00 (1)
B-C	-81.0	-91.8	-91.8 0.10 (1)	6.25	H-D	0.152	0.03 (1)
C-D	-81.0	-91.8	-91.8 0.03 (1)	6.25	P-H	0.17	0.01 (1)
E-D	-189.0	0.0	0.0 0.05 (1)	7.81	H-C	-133.0	0.01 (1)
I-B	-318.0	0.0	0.0 0.03 (1)	7.81	B-H	0.73	0.02 (1)
I-H	0.0	-18.5	-18.5 0.04 (4)	10.00			
G-F	0.0	-18.5	-18.5 0.00 (4)	10.00			
F-E	0.7	-18.5	-18.5 0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
DL	=	8.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.09/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19')
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00')
ALLOWABLE DEFL. (TL) = $L/360$ (0.19')
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00')

CS1: TC=0.14/1.00 (A-B:5), BC=0.04/1.00 (H:4),
WB=0.03/1.00 (D-H:1), SS=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION	(PSI)	(PL)	(PL)
MAX MIN MAX MIN MAX MIN			
MT20	818	354	1687 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.22 (B) (INPUT = 0.80)
JSI METAL = 0.06 (B) (INPUT = 1.00)

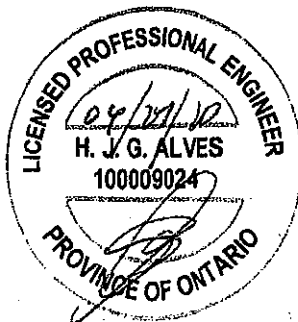

Structural component only
DWG# T-2007009

JOB NAME 408089	TRUSS NAME T44S	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 9.310.9 Oct 29 2019 MITek Industries, Inc. Sat Apr 25 09:25:58 2020 Page 1	

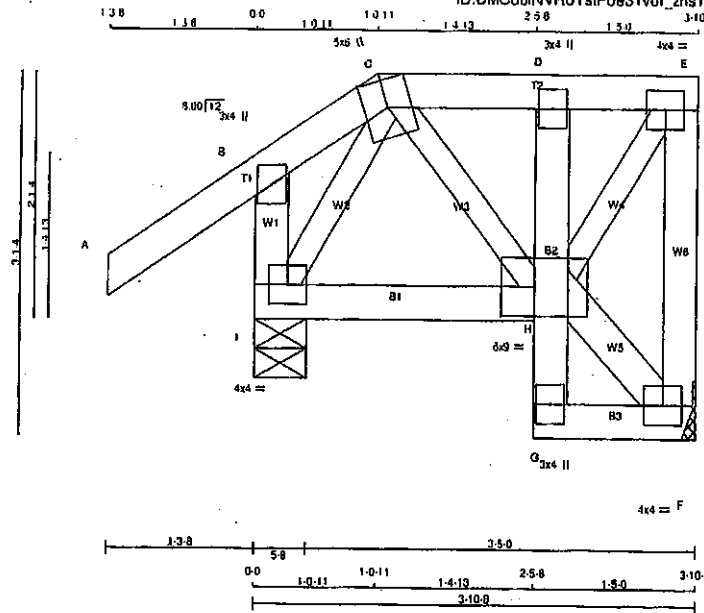

Scale = 1/16"

LUMBER				DESCR.	
N. L. G. A. RULES	SIZE	LUMBER		SPF	
CHORDS					
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
I - B	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
G - D	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
H - F	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TTWW+m	MT20	5.0	6.0	Edge	
D	TMV+p	MT20	3.0	4.0		
E	TMVW-t	MT20	4.0	4.0		
F	BMVW1-t	MT20	4.0	4.0		
G	BMV+p	MT20	3.0	4.0		
H	BMVWWW-t	MT20	8.0	9.0	3.00	3.50
I	BMVW1-t	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT		RECORD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG	BRG
F	191	0	191	0	0	MECHANICAL			
I	362	0	362	0	0	5-8	5-8		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS							
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
F	136	87/112	0/0	0/0	0/0	49/0	0/0		
I	253	182/0	0/0	0/0	0/0	71/0	0/0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LBS)	MEMB.	MAX. FORCE (LBS)	MAX. (LBS)	MAX. (LBS)
FR-TO		FROM	TO	FR-TO			
A-B	0/35	-91.8	-91.8 0.14 (5)	10.00	C-H	0/88	0.01 (1)
B-C	-44/0	-91.8	-91.8 0.13 (5)	6.25	H-F	-8/0	0.00 (1)
C-D	-83/0	-91.8	-91.8 0.03 (1)	6.25	H-E	0/155	0.03 (1)
D-E	-69/0	-91.8	-91.8 0.02 (1)	6.25	I-C	-97/38	0.01 (1)
E-F	-174/0	0.0	0.0 0.03 (1)	7.81			
F-G	-255/0	0.0	0.0 0.03 (1)	7.81			
I-H	-20/50	-18.5	-18.5 0.04 (4)	6.25			
G-H	0/13	0.0	0.0 0.01 (1)	10.00			
H-D	-147/0	0.0	0.0 0.01 (1)	7.81			
G-F	0/7	-18.5	-18.5 0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 24 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/989 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/989 (0.00")

CSI: TC=0.14/1.00 (A-B:5), BC=0.04/1.00 (H-I:4), WB=0.03/1.00 (E-H:1), SS=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.27 (H) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007010

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408089	T45	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS OESC.	

Version 3.310 S Oct 26 2019 MTEK Industries, Inc. Sat Apr 25 09:25:57 2020 Page 2
ID:DMCubINVR6TsiFoe31v6I zns1I-did7ia7moFE97DBY?nW0shW5hOnnN5ZF-Mu5rSizNECO


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
E	BMV1+p	MT20	3.0	4.0		
F	BMWW-1	MT20	5.0	6.0		
G	BMWWW-t	MT20	4.0	9.0		
H	BMV1+p	MT20	3.0	4.0		


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.81 (G) iINPUT = 0.90
JSI METAL = 0.35 (D) iINPUT = 1.00

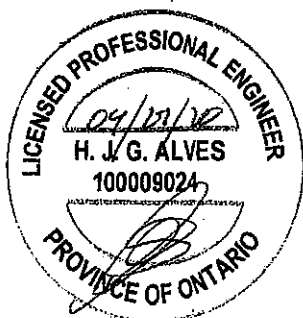

Structural component only
DWG# T-2007011

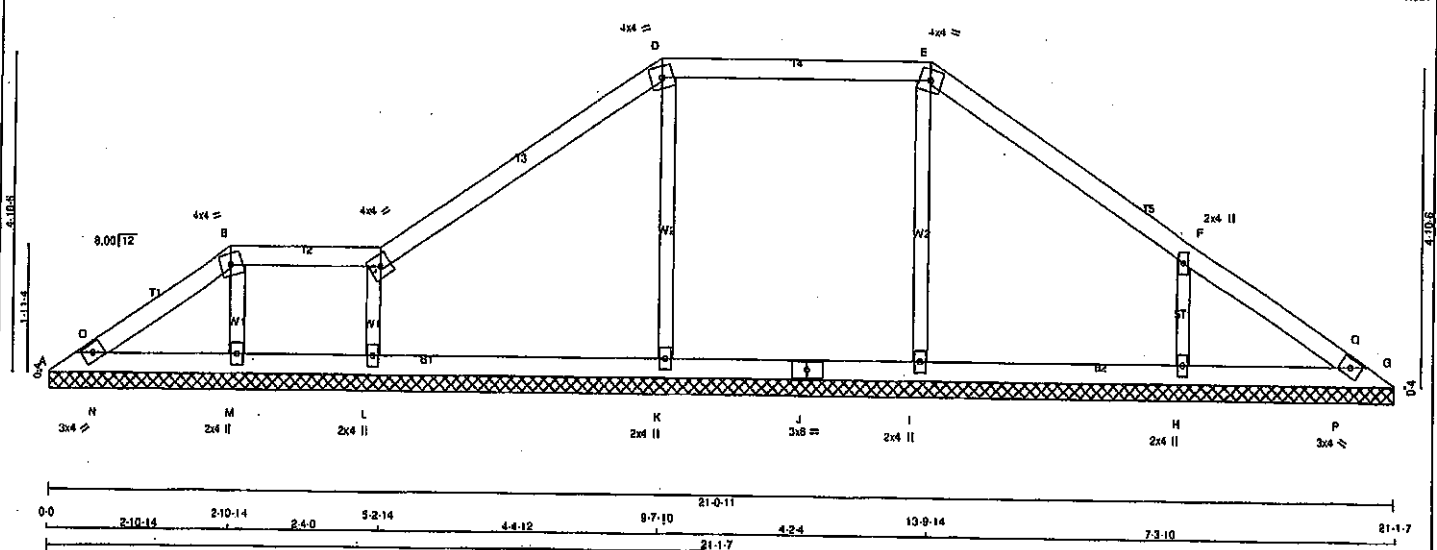

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	SPF
B - C	2x4	DRY	SPF
C - D	2x4	DRY	SPF
D - E	2x4	DRY	SPF
E - G	2x4	DRY	SPF
A - J	2x4	DRY	SPF
J - G	2x4	DRY	SPF
ALL WEBS	2x3	DRY	SPF
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	DOWN	IN-SX	IN-SX
A	147	0	21-0-11 (9-1-20) 10-11	
G	130	0	21-0-11 (9-1-20) 10-11	
H	490	0	21-0-11 (9-1-20) 10-11	
K	477	0	21-0-11 (9-1-20) 10-11	
L	363	0	21-0-11 (9-1-20) 10-11	
M	305	0	21-0-11 (9-1-20) 10-11	
I	410	0	21-0-11 (9-1-20) 10-11	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

[55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD] EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.30/1.00 (C-D:1), BC=0.09/1.00 (A-N:1), WB=0.14/1.00 (D-K:1), SS1=0.15/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B, D, E						
B	TTW-m	MT20	4.0	4.0		
C	TTW-h	MT20	4.0	4.0		
F	TMW-w	MT20	2.0	4.0		
G	TBM1-h	MT20	3.0	4.0		
H, I, K, L, M						
H	BMV1-w	MT20	2.0	4.0		
J	BS4	MT20	3.0	6.0		

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	104	70 / 0	0 / 0	0 / 0	0 / 0	0 / 0	33 / 0	0 / 0
G	91	62 / 0	0 / 0	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0
H	348	231 / 0	0 / 0	0 / 0	0 / 0	0 / 0	115 / 0	0 / 0
K	338	217 / 0	0 / 0	0 / 0	0 / 0	0 / 0	121 / 0	0 / 0
L	257	187 / 0	0 / 0	0 / 0	0 / 0	0 / 0	90 / 0	0 / 0
M	216	145 / 0	0 / 0	0 / 0	0 / 0	0 / 0	71 / 0	0 / 0
I	281	185 / 0	0 / 0	0 / 0	0 / 0	0 / 0	106 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, G, H, K, L, M, I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

FR-TO	CHORDS		WEBS	
	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD LC1 MAX (PLF) CSI (LC)	MAX. MEMB. FORCE (LBS)	MAX. FACTORED MEMB. FORCE (LBS) CSI (LC)
A-O	-5 / 3	-91.8 -91.8 0.02 (1)	10.00	H-F -400 / 0 0.06 (1)
O-B	0 / 12	-91.8 -91.8 0.08 (1)	10.00	K-D -392 / 0 0.14 (1)
B-C	0 / 17	-91.8 -91.8 0.09 (1)	10.00	L-C -311 / 0 0.05 (1)
C-D	-4 / 9	-91.8 -91.8 0.30 (1)	10.00	M-B -213 / 0 0.03 (1)
D-E	0 / 9	-91.8 -91.8 0.27 (1)	10.00	I-E -341 / 0 0.12 (1)
E-F	-23 / 5	-91.8 -91.8 0.21 (1)	6.25	N-O -103 / 0 0.00 (1)
F-G	0 / 20	-91.8 -91.8 0.21 (1)	10.00	P-Q -33 / 6 0.00 (1)
Q-G	-38 / 0	-91.8 -91.8 0.04 (1)	6.25	
A-N	-18 / 0	-18.5 -18.5 0.09 (1)	6.25	
N-M	-8 / 0	-18.5 -18.5 0.09 (1)	10.00	
M-L	-17 / 0	-18.5 -18.5 0.09 (4)	6.25	
L-K	-7 / 3	-18.5 -18.5 0.07 (4)	10.00	
K-J	-9 / 0	-18.5 -18.5 0.07 (4)	10.00	
J-I	-9 / 0	-18.5 -18.5 0.07 (4)	10.00	
I-H	-7 / 2	-18.5 -18.5 0.06 (4)	10.00	
H-P	-4 / 19	-18.5 -18.5 0.06 (4)	10.00	
P-G	-6 / 13	-18.5 -18.5 0.05 (1)	10.00	


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PLB)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1967 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.66 (C) (INPUT = 0.90)
JSI METAL = 0.20 (F) (INPUT = 1.00)



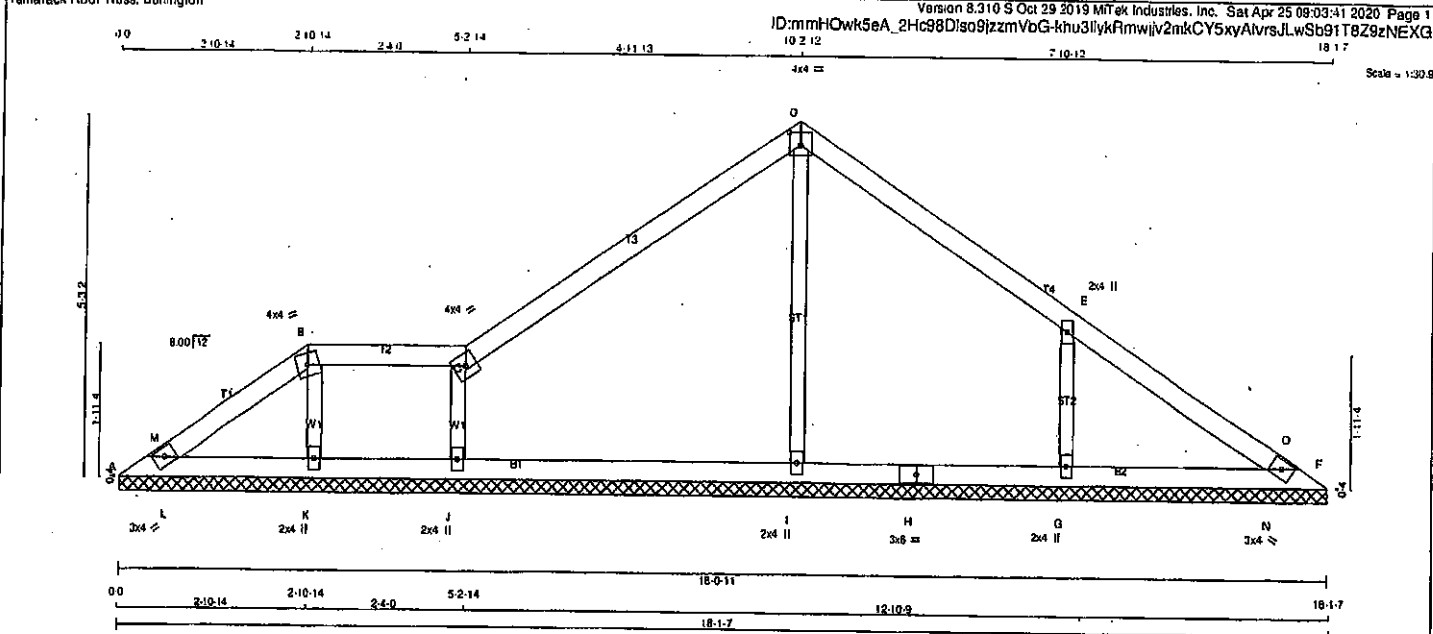

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF
B - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
A - H	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A - B	MT20	3.0	4.0		
B - C	MT20	4.0	4.0		
C - D	MT20	4.0	4.0		
D - F	MT20	4.0	4.0	2.25	2.00
E - F	MT20	2.0	4.0		
F - G	MT20	3.0	4.0		
G - H	MT20	2.0	4.0		
H - F	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
A	136	0	136	0	18-0-11 (11-1180-1)	18-0-11 (11-1180-1)
F	154	0	154	0	18-0-11 (11-1180-1)	18-0-11 (11-1180-1)
I	482	0	482	0	18-0-11 (11-1180-1)	18-0-11 (11-1180-1)
G	519	0	519	0	18-0-11 (11-1180-1)	18-0-11 (11-1180-1)
K	310	0	310	0	18-0-11 (11-1180-1)	18-0-11 (11-1180-1)
J	389	0	389	0	18-0-11 (11-1180-1)	18-0-11 (11-1180-1)

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST CASE		MAX/MIN COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
A	96	60/0	0/0	0/0	0/0	30/0	0/0
F	109	74/0	0/0	0/0	0/0	34/0	0/0
I	343	210/0	0/0	0/0	0/0	133/0	0/0
G	368	247/0	0/0	0/0	0/0	119/0	0/0
K	218	149/0	0/0	0/0	0/0	70/0	0/0
J	278	178/0	0/0	0/0	0/0	97/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, F, I, G, K, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)
A-M	0/18	-91.8	-91.8	0.03 (1)
M-B	0/33	-91.8	-91.8	0.08 (1)
B-C	0/38	-91.8	-91.8	0.09 (1)
C-D	0/21	-91.8	-91.8	0.39 (1)
D-E	-2/14	-91.8	-91.8	0.23 (1)
E-O	0/39	-91.8	-91.8	0.23 (1)
O-F	-15/5	-91.8	-91.8	0.04 (1)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)
A-L	-39/0	-18.5	-18.5	0.09 (1)
L-K	-24/0	-18.5	-18.5	0.09 (1)
K-J	-38/0	-18.5	-18.5	0.07 (4)
J-I	-17/0	-18.5	-18.5	0.08 (4)
I-H	-17/0	-18.5	-18.5	0.08 (4)
H-G	-17/0	-18.5	-18.5	0.08 (4)
G-N	-12/0	-18.5	-18.5	0.08 (1)
N-F	-16/0	-18.5	-18.5	0.08 (1)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.39/1.00 (C-D:1), BC=0.09/1.00 (K-L:1), WB=0.16/1.00 (D-I:1), SSI=0.15/1.00 (C-D:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1887 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.66 (C) (INPUT = 0.90)

JSI METAL = 0.21 (E) (INPUT = 1.00)




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408088	V23	1	1	GREEN PARK HOMES		

Tamrack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:03:44 2020 Page 1

ID:mmH0wk5eA_2Hc98Diso9jzmVbG-9GaBwn7djhlaNnLPK5oZaol42a5YI62r7hoATzNEXD

Scale = 1/20.2

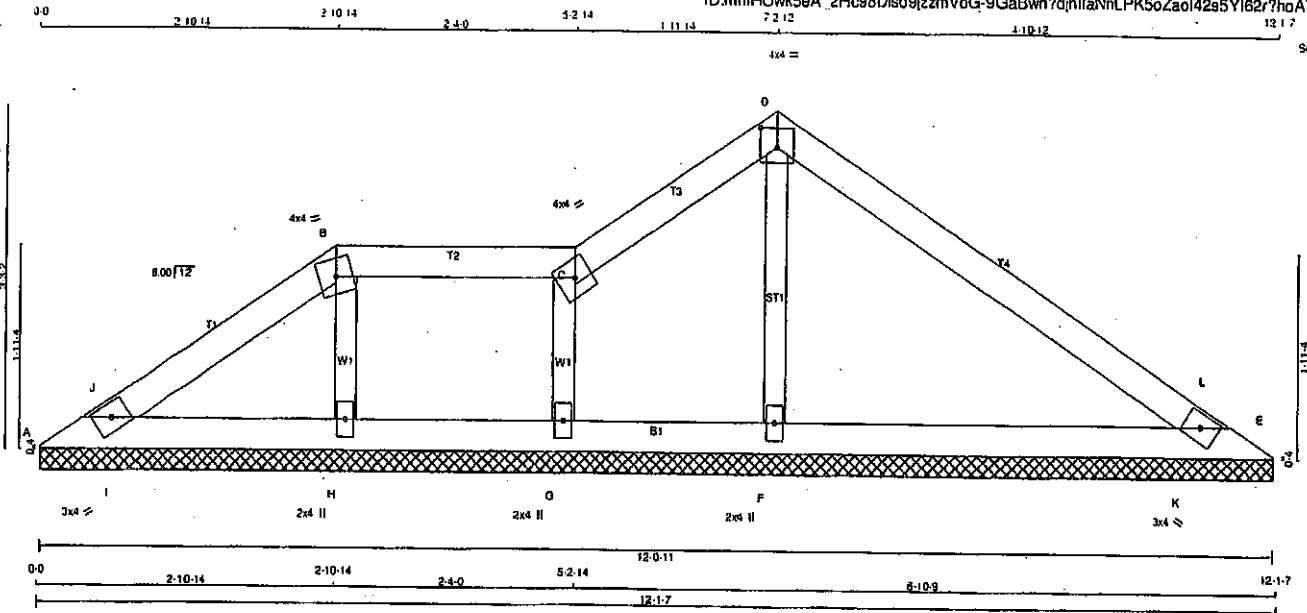

TOTAL WEIGHT = 33 lb

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS			
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
A - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
DESCR.	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG			
	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX
SPF	A	41	0	41	0	0	12-0-11	12-0-11	12-0-11
SPF	E	122	0	122	0	0	12-0-11	12-0-11	12-0-11
SPF	F	720	0	720	0	0	12-0-11	12-0-11	12-0-11
SPF	H	433	0	433	0	0	12-0-11	12-0-11	12-0-11
SPF	G	13	0	13	0	J	12-0-11	12-0-11	12-0-11

PROVIDE ANCHORAGE AT BEARING JOINT G FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS							
JT	COMBINED	1ST CASE MAX/MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	29	19/0	0/0	0/0	0/0	10/0	0/0
B	88	38/0	0/0	0/0	0/0	29/0	0/0
E	510	331/0	0/0	0/0	0/0	179/0	0/0
H	306	200/0	0/0	0/0	0/0	108/0	0/0
G	8	9/0	0/0	0/0	0/0	0/-1	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, F, H, G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-J	0/212	-91.8 -91.8 0.04 (1)	10.00	F-D	-541/0	0.10 (1)	
J-B	0/227	-91.8 -91.8 0.10 (1)	10.00	H-B	-329/0	0.05 (1)	
B-C	0/210	-91.8 -91.8 0.12 (1)	10.00	G-C	-62/0	0.01 (1)	
C-D	0/247	-91.8 -91.8 0.10 (1)	10.00	I-J	-101/0	0.00 (1)	
D-L	0/242	-91.8 -91.8 0.27 (1)	10.00	K-L	-247/0	0.00 (1)	
L-E	0/251	-91.8 -91.8 0.10 (1)	10.00				
A-I	-203/0	-18.5 -18.5 0.06 (1)	6.25				
I-H	-189/0	-18.5 -18.5 0.08 (1)	6.25				
H-G	-210/0	-18.5 -18.5 0.05 (1)	6.25				
G-F	-208/0	-18.5 -18.5 0.14 (1)	6.25				
F-K	-206/0	-18.5 -18.5 0.21 (1)	6.25				
K-E	-244/0	-18.5 -18.5 0.21 (1)	6.25				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.27/1.00 (D-L:1), BC=0.21/1.00 (F-K:1), WB=0.10/1.00 (D-F:1), SI=0.15/1.00 (E-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.45 (D) (INPUT = 0.80)
JSI METAL= 0.18 (D) (INPUT = 1.00)




Structural component only
DWG# T-2006987

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408087	J1	21	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 08:53:11 2020 Page 1
ID:DMCubINVR6TsiFoe31v6l_zns11-BUqu4KKZcCY685uhquEMP543auqFk1_iH0soSqzNEh6

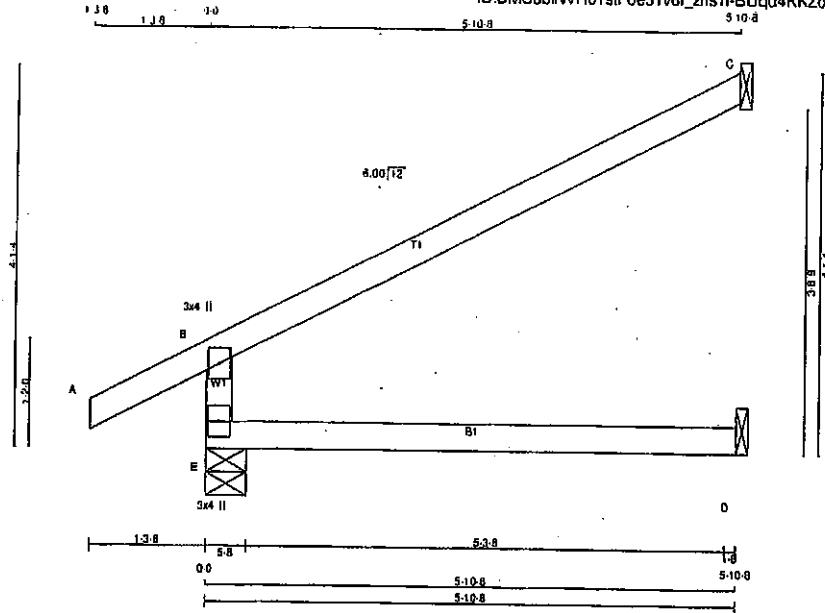

TOTAL WEIGHT = 21 X 17 = 353 lb

LUMBER				DESCR.
N. L. G. A. RULES	SIZE	LUMBER		
CHORDS				SPF
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY, SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	BRG	IN-SX	BRG	IN-SX
E	525	0	525	0	0	5-8	5-8		
C	202	0	202	0	0	1-8	1-8		
D	45	0	50	0	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B97781H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST LCASE		MAX. MIN. COMPONENT REACTIONS		LIVE		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	PERM. LIVE	WIND	DEAD	SOIL	PERM. LIVE	WIND	DEAD	SOIL
E	389	257 / 0	0 / 0	0 / 0	0 / 0	111 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0
C	139	113 / 0	0 / 0	0 / 0	0 / 0	26 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	
FR-TO		FROM	TO	FR-TO		FROM	TO	
E-B	-461 / 0	0.0	0.0 0.13 (4)	7.81		0.0	0.0 0.13 (4)	7.81
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00		-91.8	-91.8 0.12 (1)	10.00
B-C	-30 / 0	-91.8	-91.8 0.54 (1)	8.25		-91.8	-91.8 0.54 (1)	8.25
E-D	0 / 0	-18.5	-18.5 0.13 (4)	10.00		-18.5	-18.5 0.13 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4),
WB=0.00/1.00 (A:0), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.19 (E) (INPUT = 0.90)
JSI METAL= 0.13 (B) (INPUT = 1.00)

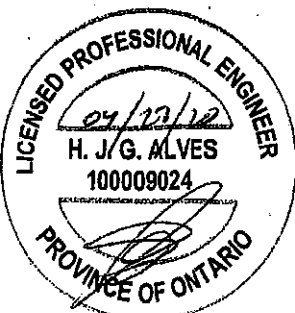


Structural component only
DWG# T-2006949

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408087	J2	9	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Sat Apr 25 08:53:12 2020 Page 1
ID:DMCubINVR6TsiFoe31v6l_zns1I-gOGHgLBZVgzlFTObmbyJdG3H8oTUDOWgbM_6zNEh5

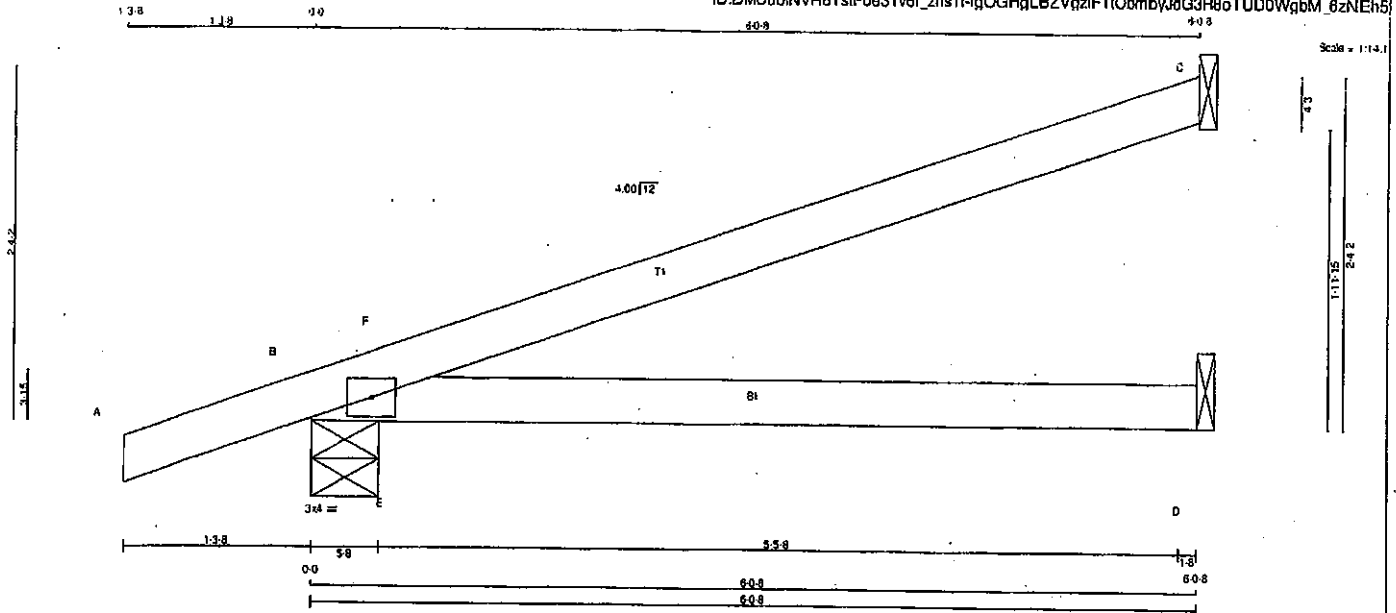

TOTAL WEIGHT = 9 X 16 = 142 lb

LUMBER					
N L G A RULES					
CHORDS	SIZE	LUMBER			
A - C	2x4	DRY	No.2		
B - D	2x4	DRY	No.2		

DRY, SEASONED LUMBER.

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
C	242	0	242	0	1-8	1-8
B	458	0	458	0	5-8	5-8
D	91	0	91	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

JT	UNFACTORED REACTIONS		MAX / MIN COMPONENT REACTIONS		WIND	DEAD	SOIL
	1ST LCASE	MAX / MIN	SNOW	LIVE			
C	188	131 / 0	0 / 0	0 / 0	0 / 0	37 / 0	0 / 0
B	320	223 / 0	0 / 0	0 / 0	0 / 0	37 / 0	0 / 0
D	88	24 / 0	0 / 0	0 / 0	0 / 0	44 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING
TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		MAX. (LC)	UNBRAC LENGTH	MEMB.	WEBS		MAX. (LC)
	MAX. FORCE (LBS)	VERT. LOAD	PLF	TO				MAX. FORCE (LBS)	MAX. (LC)	
FR-TO										
A-B	0 / 18	-91.8	-91.8	0.11 (1)	10.00	E-F	-345 / 13	0.00 (1)		
B-F	-20 / 22	-91.8	-91.8	0.06 (4)	6.25					
F-C	-2 / 2	-91.8	-91.8	0.43 (1)	10.00					
B-E	0 / 0	-18.5	-18.5	0.30 (1)	10.00					
E-D	0 / 0	-18.5	-18.5	0.30 (1)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (LL) = $L/926$ (0.08")
ALLOWABLE DEFL. (TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (TL) = $L/452$ (0.16")

CSI: TC=0.43/1.00 (C-F:1), SC=0.30/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SS=0.29/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.30 (B) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)

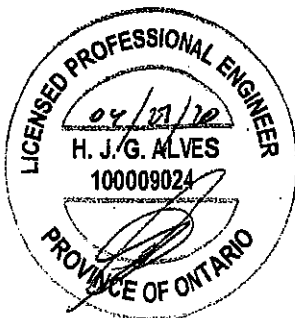


Structural component only
DWG# T-2006950

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408087	U3	5	1	TRUSS DESC.		

Famarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 08:53:12 2020 Page 1
ID:DMCubINVR6TslFoa31v6l_zns11-fgOGHqLBZVgzlFTObmbyJdJehAsTUDOWgbM_6zNEh5

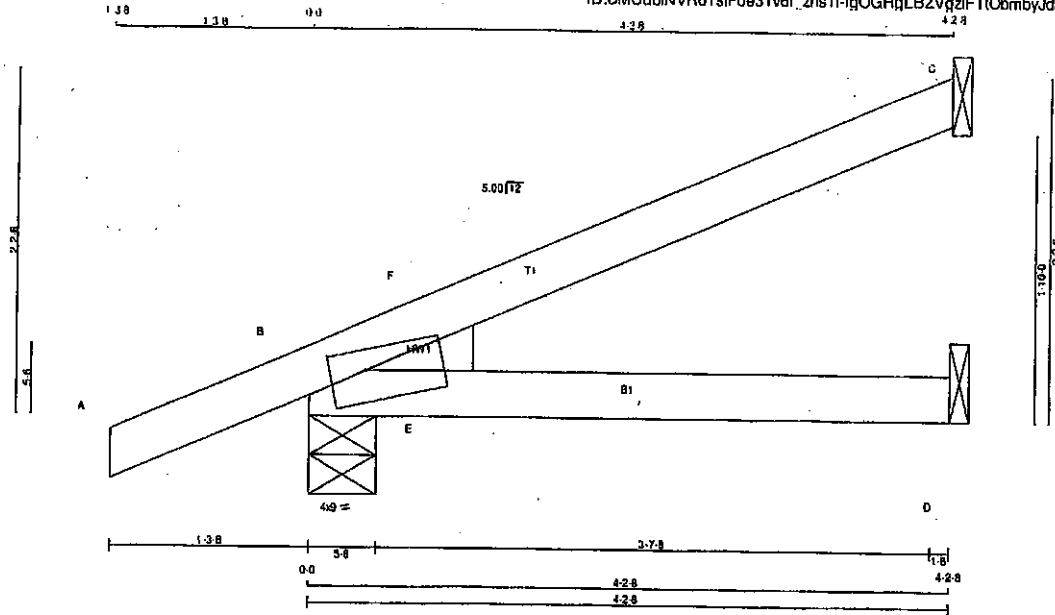

TOTAL WEIGHT = 5 X 13 = 65 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
B - D	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMBH1-m	MT20	4.0	9.0	1.50 3.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD	HEEL
	GROSS REACTION	GROSS REACTION	BRG	BRG	WEDGE
	VERT	HORZ	DOWN	HORZ	UPLIFT
C	184	0	184	0	1-8
B	356	0	356	0	5-8
D	68	0	68	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
C	113	88/0	0/0	0/0	0/0	0/0	26/0	0/0
B	249	177/0	0/0	0/0	0/0	0/0	73/0	0/0
D	51	20/0	0/0	0/0	0/0	0/0	31/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO		UNBRACED LENGTH	FR-TO		
A-B	0/18	-91.8	-91.8	0.12 (1)	10.00	E-F	-151/4
B-F	-17/0	-91.8	-91.8	0.05 (4)	6.25		0.00 (1)
F-C	0/3	-91.8	-91.8	0.20 (1)	10.00		
B-E	0/0	-18.5	-18.5	0.17 (1)	10.00		
E-D	0/0	-18.5	-18.5	0.17 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6 PSF
	DL	= 6.0 PSF
BOT CH.	LL	= 0.0 PSF
	DL	= 7.4 PSF
TOTAL LOAD		= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.18")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.18")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CS1: TC=0.20/1.00 (C-F:1), BC=0.17/1.00 (B-E:1), WB=0.00/1.00 (E-F:1), SS=0.13/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1887 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.13 (B) (INPUT = 0.90)
JSI METAL = 0.03 (B) (INPUT = 1.00)

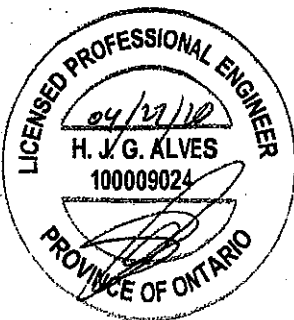


Structural component only
DWG# T-2006951

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408088	J20	5	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

ID:DMCubINVR6TstFoe31v6j_zns11-dBc8ZJoaUmH2fwZGTzp2wC8aecQM04jh9WpybPzNEXT

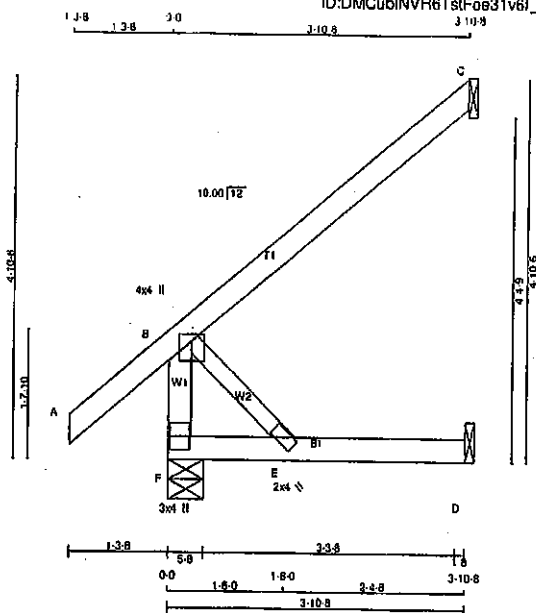

Scale = 1:27.0

<u>LUMBER</u>					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR.
F - B	2x4	DRY	No.2		SPF
A - C	2x4	DRY	No.2		SPF
F - D	2x4	DRY	No.2		SPF
ALL WEBS		2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.					

<u>PLATES (tablets in inches)</u>						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
E	BMVW+w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
F	341	0	341	0	5-8	5-8
C	178	0	178	0	1-8	1-8
D	36	0	40	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	239	170 / 0	0 / 0	0 / 0	0 / 0	0 / 0	69 / 0	0 / 0
C	122	89 / 0	0 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0
D	29	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS						WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CS1 (LC)	UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM	TO		FR-TO				
F-B	-305 / 0	0.0	0.0	0.03 (1)	7.81	B-E	0 / 0	0.00 (1)	
A-B	0 / 41	-91.8	-91.8	0.14 (5)	10.00				
B-C	0 / 0	-91.8	-91.8	0.23 (1)	10.00				
F-E	0 / 0	-18.5	-18.5	0.08 (4)	10.00				
E-D	0 / 0	-18.5	-18.5	0.08 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 5 X 15 = 75 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.01")

CS1: TC=0.23/1.00 (B-C:1), BC=0.08/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.24 (B) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006974

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408088	J21	5	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.316 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:03:30 2020 Page 1
ID:DMCubINVR6TsiFoe31v6I_zns1I-Zaku_?q:00XhVdJbOrW7dXiP7PG_D_dpI3gHzNEXR

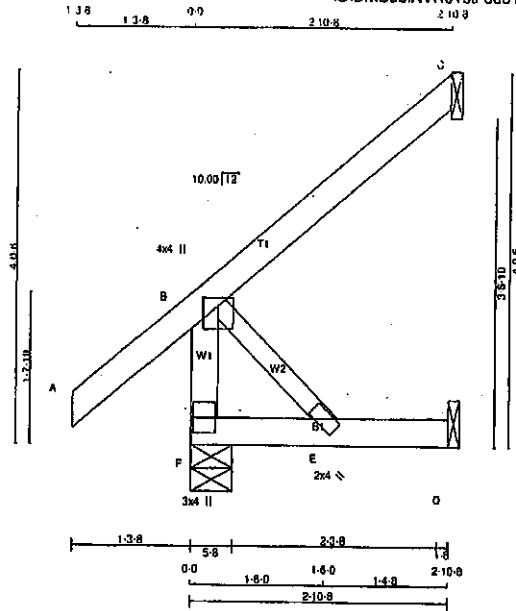

Scale = 1/32.0

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
E	BMVW+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
F	286	0	286	0	5-8
C	132	0	132	0	1-8
D	27	0	30	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST LC CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED							
F	200	144.0	0.0	0.0	0.0	55.0	0.0	0.0
C	91	74.0	0.0	0.0	0.0	17.0	0.0	0.0
D	21	0.0	0.0	0.0	0.0	21.0	0.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS		MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX. (PLF)	MEMB.	FORCE (LBS)
F-B	259.0	0.0	0.0	0.0	0.0
A-B	0.4	-91.8	-91.8	0.13 (1)	10.00
B-C	0.0	-91.8	-91.8	0.13 (1)	10.00
F-E	0.0	-18.5	-18.5	0.04 (4)	10.00
E-D	0.0	-18.5	-18.5	0.04 (4)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TO=0.13/1.00 (A-B:5), BC=0.04/1.00 (E-F:4),
WB=0.00/1.00 (B-E:1), SS=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1987 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.20 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006975

JOB NAME 408089	TRUSS NAME J30	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 09:25:35 2020 Page 1
ID:DMCubINVR6TstFoe31y8l_zns1l-GUIp43sz_UTHMfVJ87EC2bMIXKqDEE0Jtmgg_zNECK

Scale = 1/20.0

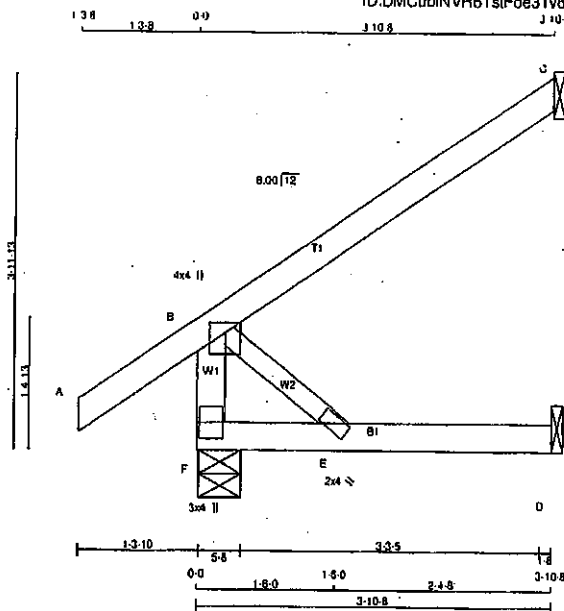

TOTAL WEIGHT = 2 X 14 = 28 lb

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR.
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS		2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.					

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMVW+p	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		IN-SE	REGRD
	VERT	HORZ	DOWN	HORZ		
F	340	0	340	0	5-8	5-8
C	178	0	178	0	1-8	1-8
D	38	0	40	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN COMPONENT REACTIONS				WIND	DEAD	SOIL
		COMBINED	SNOW	LIVE	PERM LIVE			
F	238	189 / 0	0 / 0	0 / 0	0 / 0	68 / 0	0 / 0	0 / 0
C	122	99 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0	0 / 0
D	29	0 / 0	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LOAD LC1	MAX. CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM	TO		FR-TO				
F-B	-304 / 0	0.0	0.0	0.03 (1)	7.81	B-E	0 / 0	0.00 (1)	
A-B	0 / 35	-91.8	-91.8	0.14 (5)	10.00				
B-C	0 / 0	-91.8	-91.8	0.23 (1)	10.00				
F-E	0 / 0	-18.5	-18.5	0.08 (4)	10.00				
E-D	0 / 0	-18.5	-18.5	0.08 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.8 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/380 (0.19")

CALCULATED VERT. DEFL. (LL) = L/999 (0.00")

ALLOWABLE DEFL. (TL) = L/380 (0.19")

CALCULATED VERT. DEFL. (TL) = L/999 (0.01")

CSI: TC=0.23/1.00 (B-C:1), BC=0.08/1.00 (D-E:4).

WB=0.00/1.00 (B-E:1), SS=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1867
			1867

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.90)

JSI METAL = 0.08 (B) (INPUT = 1.00)

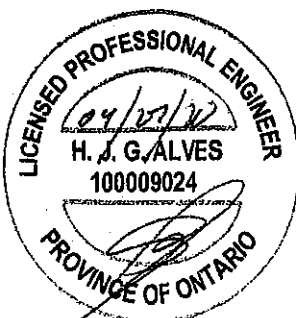


Structural component only
DWG# T-2006993

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408089	J31S	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 09:25:36 2020 Page 1
ID:DMCubINVR6TslFoe31v6l_zns1l-kg8BHOtlob8_74VGteTf8Y7whmyh9X7VECRzNEC

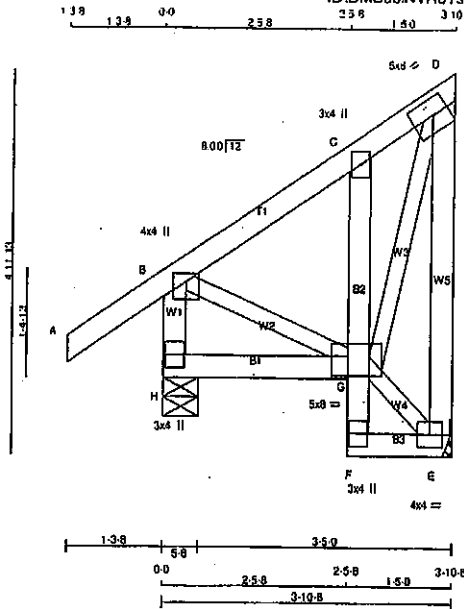

Scale = 1/2" = 1'

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
H - B	2x4 DRY	No.2	SPF
A - D	2x4 DRY	No.2	SPF
H - G	2x4 DRY	No.2	SPF
F - C	2x4 DRY	No.2	SPF
F - E	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			
E - D	2x4 DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
C	TMV+p	MT20	3.0	4.0	
D	TMWW-I	MT20	5.0	8.0	2.50 2.50
E	BMVW-I	MT20	4.0	4.0	
F	BMV+p	MT20	3.0	4.0	
G	BMVWW-I	MT20	5.0	8.0	3.00 2.50
H	BMV+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
JT	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
H	332 0	332 0	0 0	5-8	5-8
E	206 0	206 0	0 0	MECHANICAL	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	232	188 / 0	0 / 0	0 / 0	0 / 0	0 / 0	68 / 0	0 / 0
E	145	95 / 0	0 / 0	0 / 0	0 / 0	0 / 0	50 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (6)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX (LC) UNBRACED LENGTH (FR-TO)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED LC1 MAX (LC) UNBRACED LENGTH (FR-TO)	
H-B	-307 / 0	0.0	0.0 0.03 (1)	B-G	0 / 83	0.02 (1)	
A-B	0 / 35	-91.8	-91.8 0.14 (5)	E-D	-184 / 0	0.05 (1)	
B-C	-83 / 0	-91.8	-91.8 0.07 (1)	G-E	-17 / 0	0.00 (1)	
C-D	-99 / 0	-91.8	-91.8 0.08 (1)	G-D	0 / 219	0.05 (1)	
H-G	0 / 0	-18.5	-18.5 0.04 (4)				
F-G	0 / 12	0.0	0.0 0.02 (1)				
G-C	-218 / 0	0.0	0.0 0.02 (1)				
F-E	0 / 13	-18.5	-18.5 0.01 (4)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 28 = 83 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6 PSF
	DL	= 8.0 PSF
BOT CH.	LL	= 0.0 PSF
	DL	= 7.4 PSF
TOTAL LOAD		= 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, OBC 2012, ABC 2018
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/380 (0.19")$
CALCULATED VERT. DEFL.(LL) = $L/999 (0.00")$
ALLOWABLE DEFL.(TL) = $L/380 (0.19")$
CALCULATED VERT. DEFL.(TL) = $L/999 (0.00")$

CSI: TC=0.14/1.00 (A-B-5), BC=0.04/1.00 (G-H-4), WB=0.05/1.00 (D-G-1), SS=0.09/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX MIN
MT20	618	354	1687 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.21 (B) (INPUT = 0.90)
JSI METAL= 0.08 (G) (INPUT = 1.00)

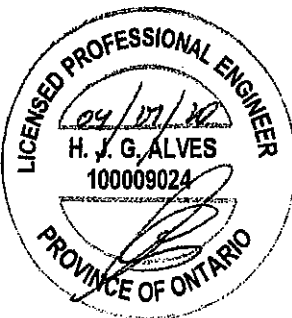


Structural component only
DWG# T-2006994

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Sat Apr 26 09:25:38 2020 Page 1
ID:DMCubINVR6TstFoe3fv6l zns1l-g3zx4urHPrsDJEUoIgxpgDvTKNNOb S?R LHJzNECh

Scale = 1:22.8

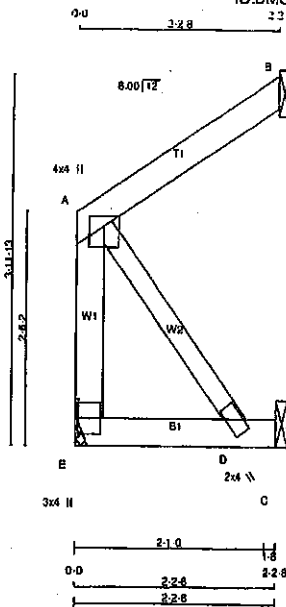

TOTAL WEIGHT = 4 X 10 = 40 lb
(M)(F)

<u>LUMBER</u>				
N. L. G. A. RULES				
CHORDS		SIZE	LUMBER	DESIGN
E - A	2x4	DRY	No.2	SPF
A - B	2x4	DRY	No.2	SPF
E - C	2x4	DRY	No.2	SPF
ALL WEBS		2x3	DRY	No.2
DRY: SEASONED LUMBER.				

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
D	BMVW+p	MT20	2.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX MECHANICAL
E	122	0	122	0	0	
B	101	0	101	0	0	1-8
C	20	0	23	0	0	1-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1'-8".

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	88	58 / 0	0 / 0	0 / 0	0 / 0	30 / 0	0 / 0
B	70	58 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0
C	18	0 / 0	0 / 0	0 / 0	0 / 0	18 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBB			
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO		FR-TO			
E-A	-101.0	0.0	0.0 (1)	7.81	A-D	0.0	0.00 (1)
A-B	0.0	-91.8	-91.8 0.08 (1)	10.00			
E-D	0.0	-18.5	-18.5 0.03 (4)	10.00			
D-C	0.0	-18.5	-18.5 0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL	=	25.6	PSF
		DL	=	6.0	PSF
BOT	CH.	LL	=	0.0	PSF
		DL	=	7.4	PSF
TOTAL LOAD				=	39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= 1/360 (0.19")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.00")
ALLOWABLE DEFL.(TL)= 1/360 (0.19")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.00")

CSI: TC=0.08/1.00 (A-B:1), BC=0.03/1.00 (D-E:4),
WB=0.00/1.00 (A-D:1), SSI=0.07/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.07 (A) (INPUT = 0.90)
JSI METAL= 0.02 (A) (INPUT = 1.00)

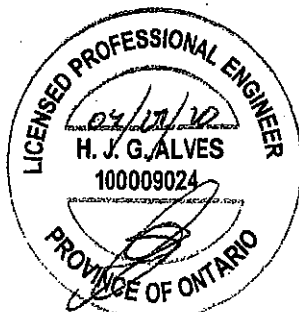


Structural component only
DWG# T-2006995

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408087	V01	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 08:53:28 2020 Page 1
ID:DMCubINVR6TstF0e31v6l, zns11-FNEZDTWzGpR_RPXaCX0IWFC7xyul64kr_5T1zNEg

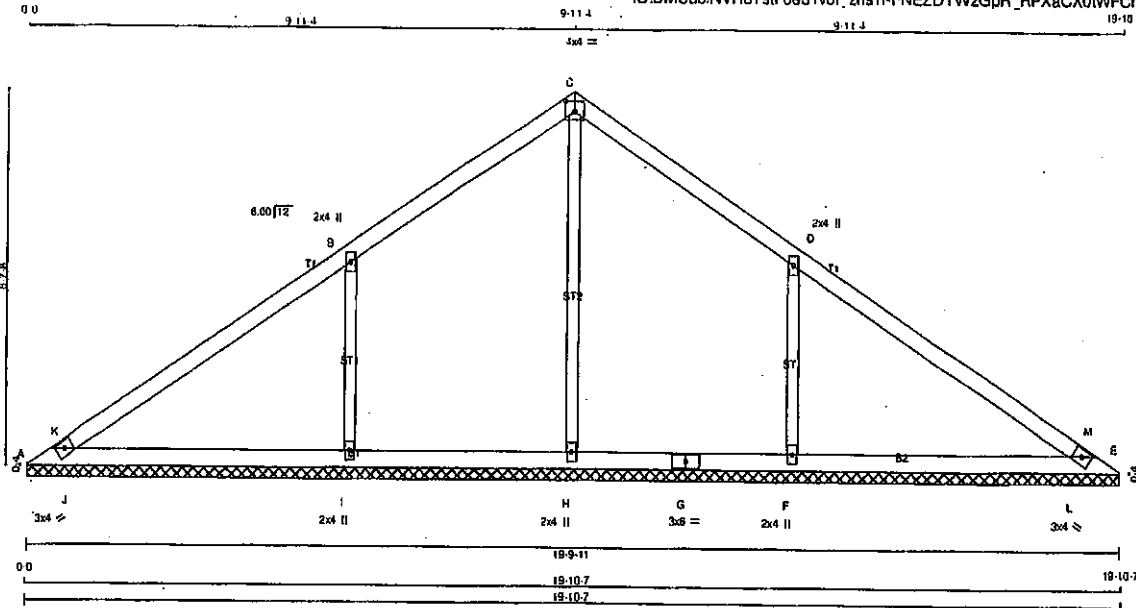

Scale = 1:12.7

TOTAL WEIGHT = 59 lb (M)

LUMBER				DESCR.
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER		
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
A - G	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF
ALL WEBS 2x3 DRY No.2				SPF
DRY: SEASONED LUMBER.				

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TBM1-h	MT20	3.0	4.0	
B	TBM1-w	MT20	2.0	4.0	
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TBM1-w	MT20	2.0	4.0	
E	TBM1-h	MT20	3.0	4.0	
F, H, I					
F	BMW1-w	MT20	2.0	4.0	
G	BS-t	MT20	3.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORIZ	BRG	BRG	IN-SX	IN-SX
A	110	0	110	0	0	19-9-11 (7-9-18)	19-11		
E	110	0	110	0	0	19-9-11 (7-9-18)	19-11		
H	612	0	612	0	0	19-9-11 (7-9-18)	19-11		
I	676	0	676	0	0	19-9-11 (7-9-18)	19-11		
F	676	0	676	0	0	19-9-11 (7-9-18)	19-11		

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	77	647.0	0.0	0.0	0.0	24.0	0.0
E	77	647.0	0.0	0.0	0.0	24.0	0.0
H	435	274.0	0.0	0.0	0.0	161.0	0.0
I	478	318.0	0.0	0.0	0.0	161.0	0.0
F	478	318.0	0.0	0.0	0.0	161.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, H, I, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.26 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	FORCE (LBS)	LC1 MAX (LC)	
FR-TO		FROM	TO	FR-TO		FROM	TO
A-K	0.286	-91.8	-91.8 0.08 (1)	10.00	H-C	-597.0	0.42 (1)
K-B	0.322	-91.8	-91.8 0.39 (1)	10.00	I-B	-516.0	0.13 (1)
B-C	0.277	-91.8	-91.8 0.38 (1)	10.00	F-D	-516.0	0.13 (1)
C-D	0.277	-91.8	-91.8 0.38 (1)	10.00	J-K	-205.7	0.00 (1)
D-M	0.322	-91.8	-91.8 0.39 (1)	10.00	L-M	-205.7	0.00 (1)
M-E	0.286	-91.8	-91.8 0.08 (1)	10.00			
A-J	-281.0	-18.5	-18.5 0.18 (1)	6.25			
J-I	-247.0	-18.5	-18.5 0.19 (1)	6.25			
I-H	-258.0	-18.5	-18.5 0.14 (1)	6.25			
H-G	-258.0	-18.5	-18.5 0.14 (1)	6.25			
G-F	-258.0	-18.5	-18.5 0.14 (1)	6.25			
F-L	-247.0	-18.5	-18.5 0.19 (1)	6.25			
L-E	-281.0	-18.5	-18.5 0.18 (1)	6.25			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

[55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD] EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.38/1.00 (D-M1), BC=0.19/1.00 (F-L1),
WB=0.42/1.00 (G-H1), SS=0.18/1.00 (D-M1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 816 354 1667 768 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.50 (C) (INPUT = 0.90)
JSI METAL = 0.26 (D) (INPUT = 1.00)




Structural component only
DWG# T-2006969

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408087	V02	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 08:53:27 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-jZoxRpXb16Zr3Y6mmFX63TlssKJRUE_DzVkl7kzNEgs

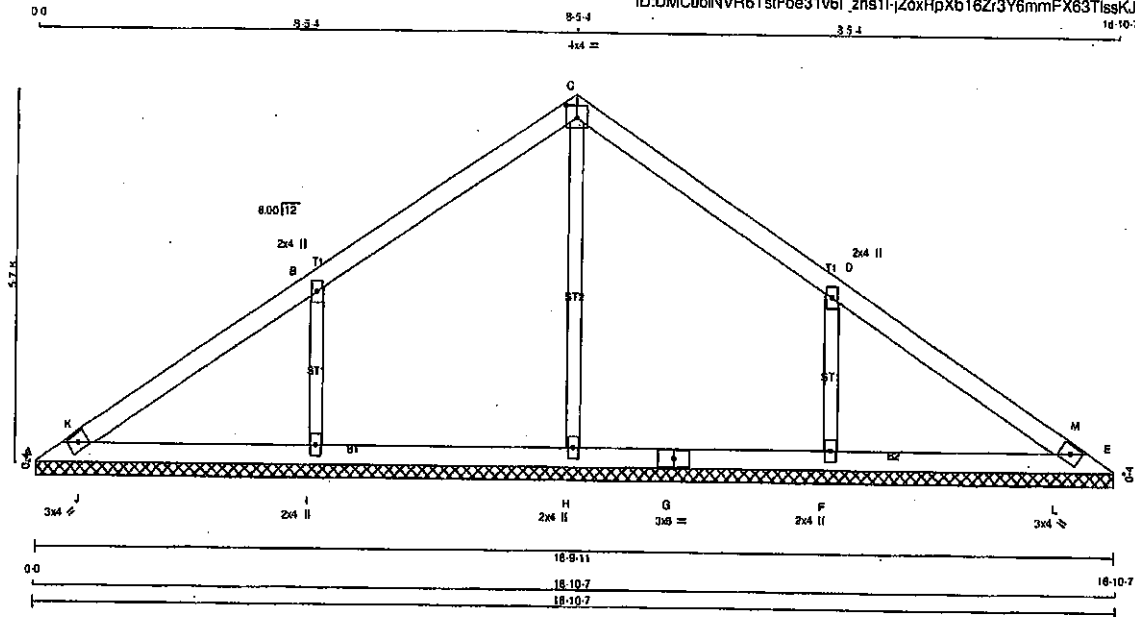

Scale: 3/8"=1'

LUMBER				N. L. G. A. RULES	
CHORDS	SIZE	LUMBER	DESCR.	SPF	SPF
A - C	2x4	DRY	No.2	SPF	SPF
C - E	2x4	DRY	No.2	SPF	SPF
A - G	2x4	DRY	No.2	SPF	SPF
G - E	2x4	DRY	No.2	SPF	SPF
ALL WEBS 2x3 DRY No.2				SPF	SPF
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
A - TBM1-h	MT20	3.0	4.0		
B - TBMW-w	MT20	2.0	4.0		
C - TTVW-p	MT20	4.0	4.0	2.25	2.00
D - TBMW-w	MT20	2.0	4.0		
E - TBM1-h	MT20	3.0	4.0		
F, H, I					
F - BMW1-w	MT20	2.0	4.0		
G - BS-t	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
A	140	0	140	0	18'-9-11 (6'-9-10)9-11	
E	140	0	140	0	18'-9-11 (6'-9-10)9-11	
H	455	0	455	0	18'-9-11 (6'-9-10)9-11	
I	559	0	559	0	18'-9-11 (6'-9-10)9-11	
F	559	0	559	0	18'-9-11 (6'-9-10)9-11	

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	COMBINED	MAX/MIN COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	98	68/0	0/0	0/0	0/0	31/0	0/0
E	98	68/0	0/0	0/0	0/0	31/0	0/0
H	325	198/0	0/0	0/0	0/0	127/0	0/0
I	395	264/0	0/0	0/0	0/0	131/0	0/0
F	395	264/0	0/0	0/0	0/0	131/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, H, I, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED				WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX	CS1 (LC)	UNBRAC	MEMB.	FORCE (LBS)	MAX	CS1 (LC)
FR-TO		FROM	TO		LENGTH	FR-TO			
A-K	0/73	-91.8	-91.8	0.04 (4)	10.00	H-C	-408/0	0.19 (1)	
K-B	0/122	-91.8	-91.8	0.26 (1)	10.00	I-B	-440/0	0.08 (1)	
B-C	0/83	-91.8	-91.8	0.26 (1)	10.00	F-D	-440/0	0.08 (1)	
C-D	0/83	-91.8	-91.8	0.26 (1)	10.00	J-K	-103/8	0.00 (1)	
D-M	0/122	-91.8	-91.8	0.26 (1)	10.00	L-M	-103/8	0.00 (1)	
M-E	0/73	-91.8	-91.8	0.04 (4)	10.00				
A-J	-94/0	-18.5	-18.5	0.10 (1)	6.25				
J-I	-78/0	-18.5	-18.5	0.10 (1)	6.25				
I-H	-89/0	-18.5	-18.5	0.08 (4)	6.25				
H-G	-89/0	-18.5	-18.5	0.08 (4)	6.25				
G-F	-89/0	-18.5	-18.5	0.08 (4)	6.25				
F-L	-78/0	-18.5	-18.5	0.10 (1)	6.25				
L-E	-94/0	-18.5	-18.5	0.10 (1)	6.25				

TOTAL WEIGHT = 49 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCG 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS1: TC=0.28/1.00 (D-M:1), BC=0.10/1.00 (F-L:1), WB=0.19/1.00 (C-H:1), SS=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1867 788 1987 1858

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.34 (C) (INPUT = 0.90)

JSI METAL= 0.22 (B) (INPUT = 1.00)

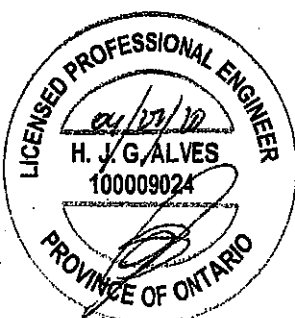


Structural component only
DWG# T-2008970

JOB NAME 408087	TRUSS NAME V03	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTX Industries, Inc. Sat Apr 25 08:53:28 2020 Page 1
ID:c7zNP0tlllyWS63lmM57zmVgW-8IMJe8YDQhghyKy2LbgH0ukd2DfDNB9TCXBzNeg

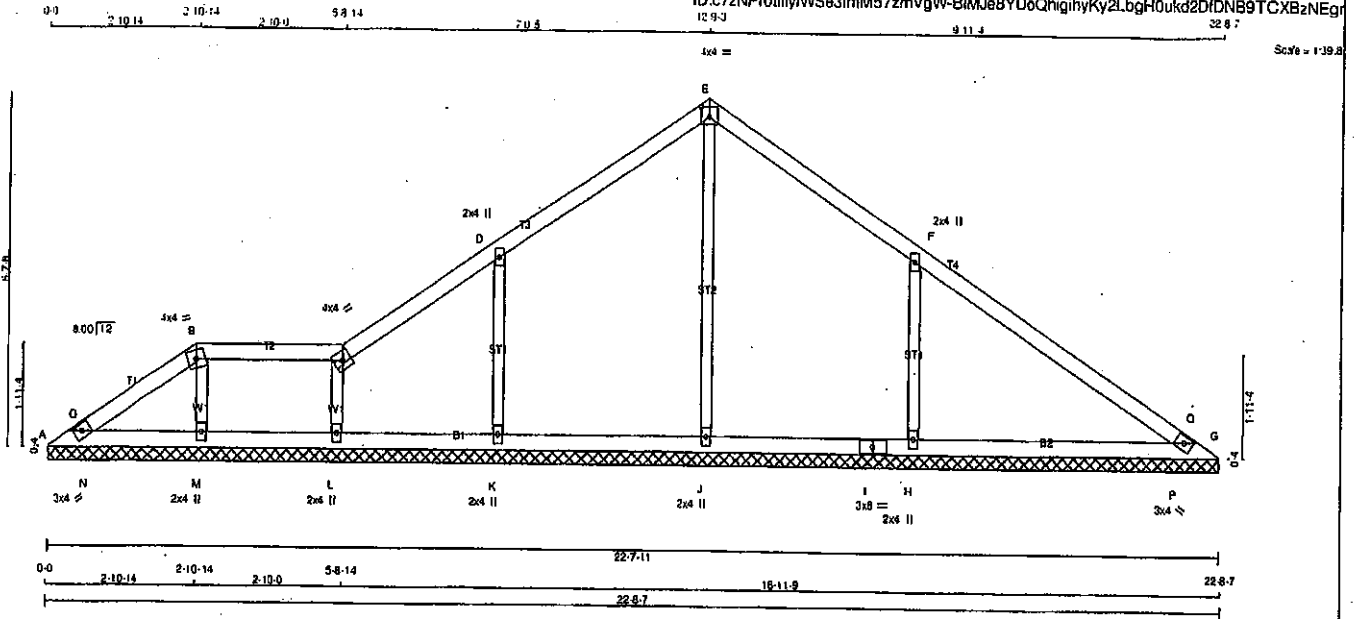

TOTAL WEIGHT = 68 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
A - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	UP	BRG	BRG	BRG
A	85	0	85	0	0	22-7-11	(15-122-2-1)		
G	187	0	187	0	0	22-7-11	(15-122-2-1)		
J	493	0	493	0	0	22-7-11	(15-122-2-1)		
K	485	0	485	0	0	22-7-11	(15-122-2-1)		
H	681	0	681	0	0	22-7-11	(15-122-2-1)		
L	166	0	166	0	0	22-7-11	(15-122-2-1)		
M	399	0	399	0	0	22-7-11	(15-122-2-1)		

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	60	43/0	0/0	0/0	0/0	17/0	0/0
G	132	89/0	0/0	0/0	0/0	43/0	0/0
J	351	218/0	0/0	0/0	0/0	133/0	0/0
K	342	231/0	0/0	0/0	0/0	111/0	0/0
H	481	319/0	0/0	0/0	0/0	162/0	0/0
L	118	76/0	0/0	0/0	0/0	42/0	0/0
M	283	182/0	0/0	0/0	0/0	100/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, G, J, K, H, L, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.	FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	CS1 (LC)
FR-TO		FROM TO		FR-TO			
A-O	0/121	-91.8 -91.8 0.03 (1)	10.00	J-E	-451/0	0.32 (1)	
O-B	0/138	-91.8 -91.8 0.09 (1)	10.00	K-D	-405/0	0.10 (1)	
B-C	0/131	-91.8 -91.8 0.15 (1)	10.00	H-F	-321/0	0.13 (1)	
C-D	0/176	-91.8 -91.8 0.24 (1)	10.00	L-C	-132/0	0.02 (1)	
D-E	0/138	-91.8 -91.8 0.23 (1)	10.00	M-B	-304/0	0.04 (1)	
E-F	0/124	-91.8 -91.8 0.37 (1)	10.00	N-O	-101/0	0.00 (1)	
F-G	0/172	-91.8 -91.8 0.37 (1)	10.00	P-Q	-206/6	0.00 (1)	
Q-G	0/138	-91.8 -91.8 0.06 (4)	10.00				

A-N	-128/0	-18.5 -18.5 0.07 (1)	8.25
N-M	-112/0	-18.5 -18.5 0.07 (1)	8.25
M-L	-131/0	-18.5 -18.5 0.05 (1)	8.25
L-K	-123/0	-18.5 -18.5 0.06 (4)	8.25
K-J	-132/0	-18.5 -18.5 0.06 (4)	8.25
J-I	-132/0	-18.5 -18.5 0.14 (1)	8.25
I-H	-132/0	-18.5 -18.5 0.14 (1)	8.25
H-P	-120/0	-18.5 -18.5 0.21 (1)	8.25
P-G	-158/0	-18.5 -18.5 0.21 (1)	8.25

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CS1: TC=0.37/1.00 (F-Q:1), BC=0.21/1.00 (H-P:1),
WB=0.32/1.00 (E-J:1), SS=0.18/1.00 (F-Q:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.66 (C) (INPUT = 0.80)
JSI METAL = 0.27 (F) (INPUT = 1.00)




Structural component only
DWG# T-2006971

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408087	V04	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington


Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 08:53:29 2020 Page 1
ID: x7zNP0tlllyWSa3lmM57zmVgW-lywhsUYrZkpZIsG9tgZa8uqCSB_py8qWQpDI4dzNEgq

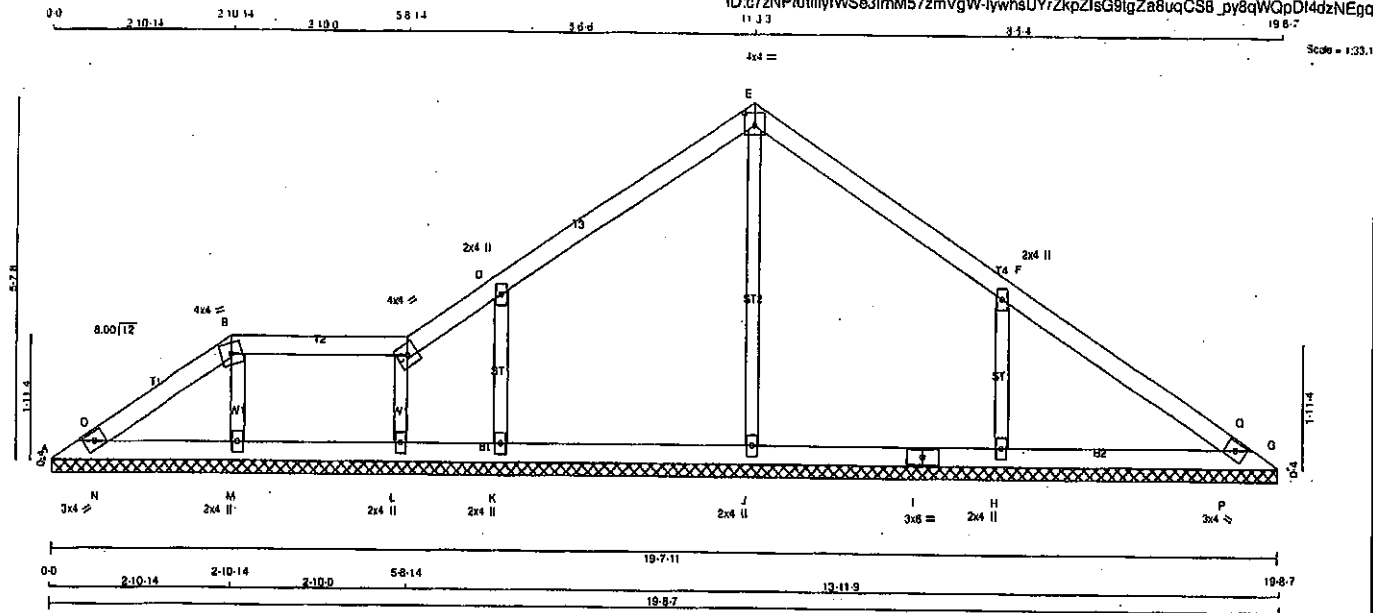

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408087	V05	1	1	TRUSS DESC.		

Tamareck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 08:53:29 2020 Page 1
ID:c7zNPr0WllylWSe3lmM57zmVgW-fywhsUYrZkoZisG9tgZa8uqDWB_4y9lWQpDI4dzNEqq

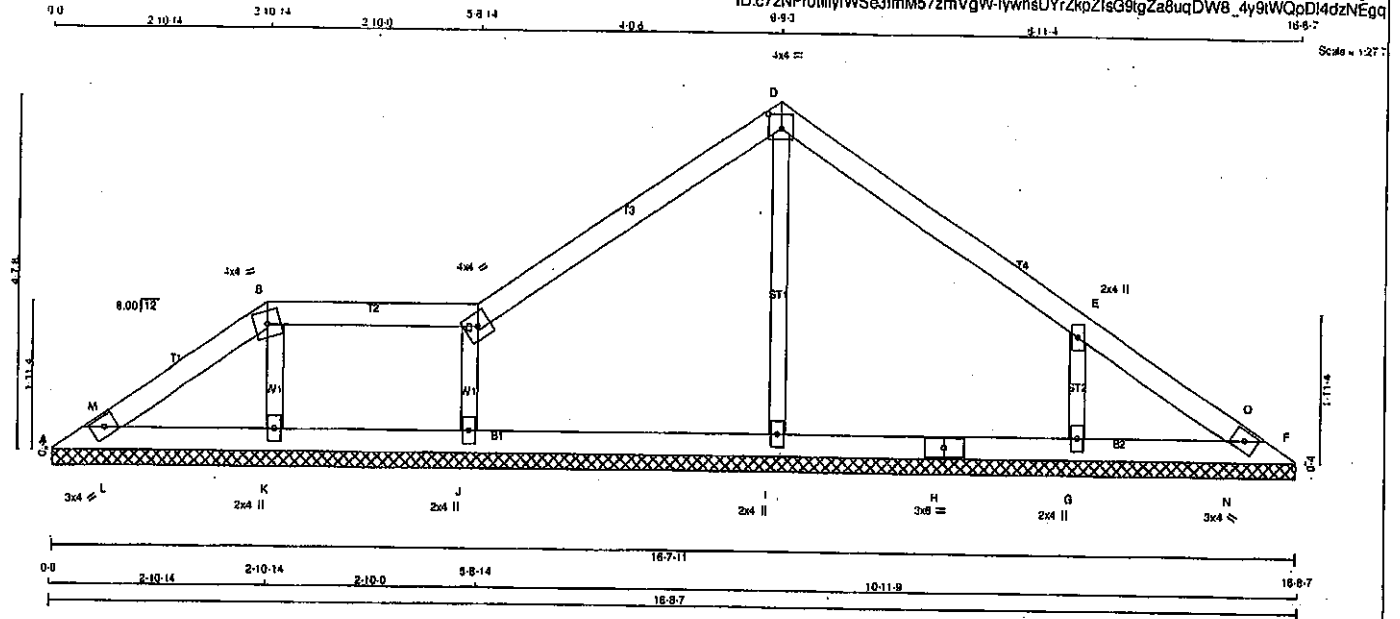

TOTAL WEIGHT = 47 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
A - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TBM1-h	MT20	3.0	4.0	
B	TTW-m	MT20	4.0	4.0	
C	TTW-p	MT20	4.0	4.0	
D	TTW-p	MT20	4.0	4.0	2.25 2.00
E	TMW-w	MT20	2.0	4.0	
F	TBM1-h	MT20	3.0	4.0	
G, I, J, K					
G	BMW1-w	MT20	2.0	4.0	
H	BS-t	MT20	3.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	
	VERT	DOWN	DOWN	DOWN	
A	148	0	0	16-7-11 (11-1182-11)	
F	109	0	0	16-7-11 (11-1182-11)	
I	409	0	0	16-7-11 (11-1182-11)	
G	466	0	0	16-7-11 (11-1182-11)	
J	389	0	0	16-7-11 (11-1182-11)	
K	333	0	0	16-7-11 (11-1182-11)	

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS							
JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD
A	104	71 / 0	0 / 0	0 / 0	0 / 0	33 / 0	0 / 0
F	77	52 / 0	0 / 0	0 / 0	0 / 0	25 / 0	0 / 0
I	291	179 / 0	0 / 0	0 / 0	0 / 0	113 / 0	0 / 0
G	328	222 / 0	0 / 0	0 / 0	0 / 0	107 / 0	0 / 0
J	261	173 / 0	0 / 0	0 / 0	0 / 0	88 / 0	0 / 0
K	235	155 / 0	0 / 0	0 / 0	0 / 0	81 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, F, I, G, J, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-M	-8 / 1	-91.8	-91.8 0.02 (1)	10.00	I-O	-329 / 0	0.10 (1)
M-B	0 / 10	-91.8	-91.8 0.08 (1)	10.00	G-E	-392 / 0	0.08 (1)
B-C	0 / 15	-91.8	-91.8 0.13 (1)	10.00	J-C	-319 / 0	0.05 (1)
C-D	-8 / 7	-91.8	-91.8 0.25 (1)	10.00	K-B	-234 / 0	0.03 (1)
D-E	-26 / 3	-91.8	-91.8 0.20 (1)	6.25	L-M	-104 / 0	0.00 (1)
E-O	0 / 19	-91.8	-91.8 0.21 (1)	10.00	N-O	-8 / 7	0.00 (1)
O-F	-43 / 0	-91.8	-91.8 0.04 (1)	6.25			
A-L	-16 / 0	-18.5	-18.5 0.09 (1)	6.25			
L-K	-6 / 0	-18.5	-18.5 0.09 (1)	10.00			
K-J	-15 / 0	-18.5	-18.5 0.05 (1)	6.25			
J-I	-6 / 5	-18.5	-18.5 0.07 (4)	10.00			
I-H	-8 / 5	-18.5	-18.5 0.07 (4)	10.00			
H-G	-8 / 5	-18.5	-18.5 0.07 (4)	10.00			
G-N	-2 / 25	-18.5	-18.5 0.05 (4)	10.00			
N-F	-3 / 22	-18.5	-18.5 0.09 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2010, NBCO 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.25/1.00 (C-D:1), BC=0.09/1.00 (A-L:1), WB=0.10/1.00 (D-I:1), SSI=0.15/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1856

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.31 (C) (INPUT = 0.90)
JSI METAL = 0.20 (E) (INPUT = 1.00)

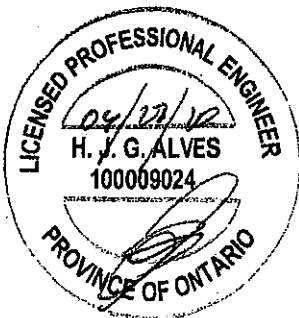

Structural component only
DWG# T-2006973

JOB NAME 408089	TRUSS NAME C30	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:25:30 2020 Page 1 ID:DMCubINVR6TstF0e31v6I, zns11-vWUv1Loq9yr_G4dLwcX2V_uVBWcuY_7G9B2v7nzNECP		

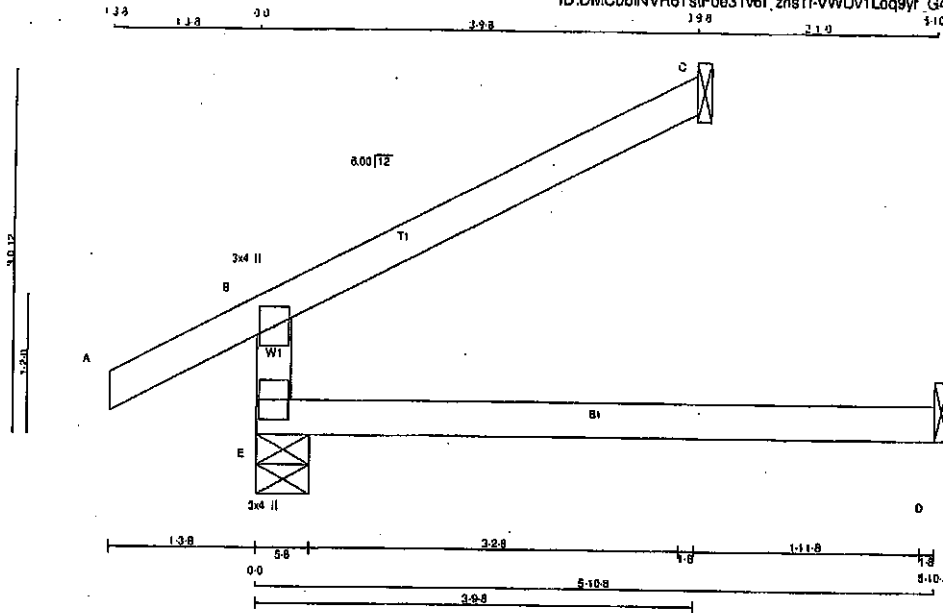

TOTAL WEIGHT = 3 X 14 = 42 lb (M)

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY-SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		RECORD BRG	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
E		408	0	408	0	0	5-8	5-8	
C		131	0	131	0	0	1-8	1-8	
D		45	0	50	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	286	191 / 0	0 / 0	0 / 0	0 / 0	98 / 0	0 / 0
C	90	73 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	38	0 / 0	0 / 0	0 / 0	0 / 0	38 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED				WEBS		FACTORED	
MEMB.		FORCE (LBS)	VERT. LOAD (PLF)	LC1 (LC)	MAX. UNBRACED LENGTH	MEMB.		FORCE (LBS)	MAX. CS1 (LC)
FR-TO			FROM TO			FR-TO			
E-B	-342 / 0	0.0	0.0	0.13 (4)	7.81				
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00				
B-C	-19 / 0	-91.8	-91.8	0.22 (1)	6.25				
E-D	0 / 0	-18.5	-18.5	0.13 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CS1: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (A:0), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 783	1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006988

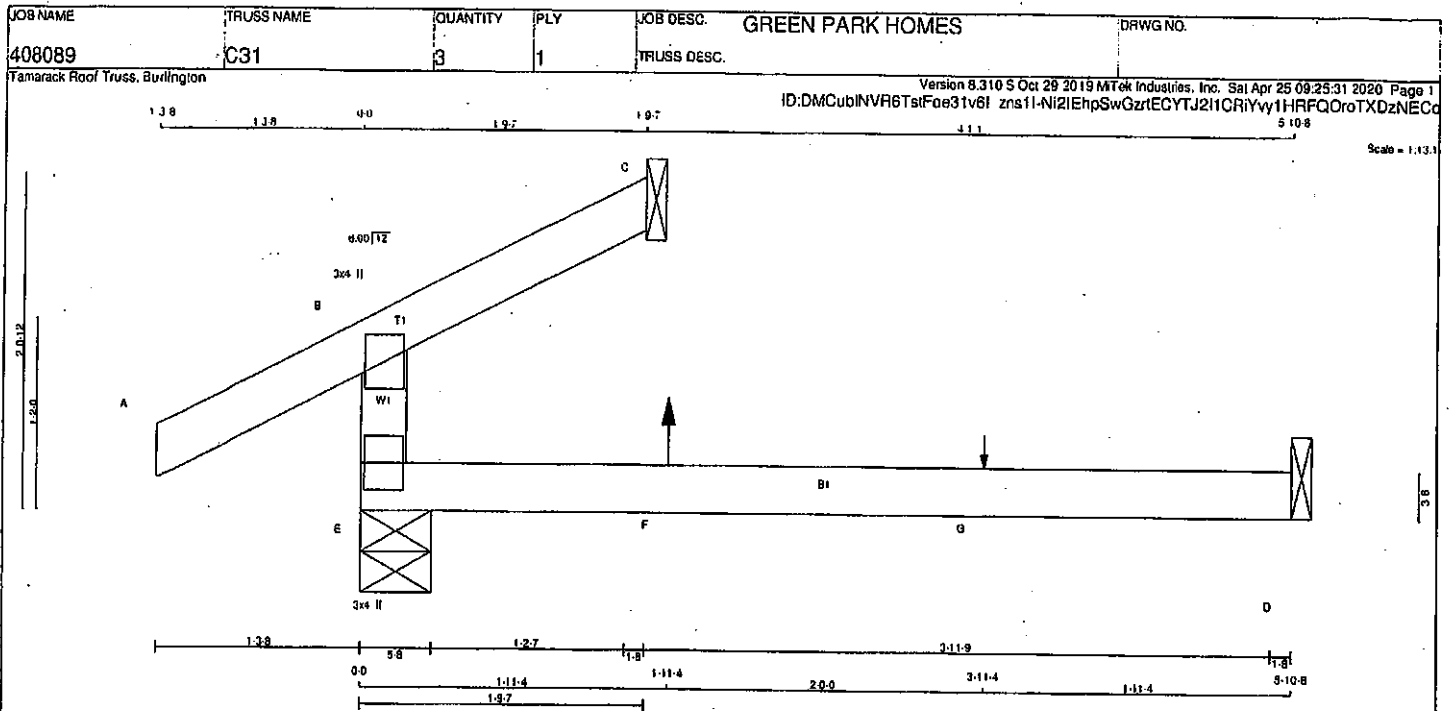

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQ'D BRG
	VERT	HORZ	DOWN	HORZ		
E	284	0	284	0	5-8	5-8
C	83	0	83	0	1-8	1-8
D	44	0	52	0	1-8	1-8

SEE MITEK STANDARD DETAIL B87791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOSE COMBINED	MAX/MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	250	137/0	0/0	0/0	0/0	62/0	0/0
C	48	21/0	0/0	0/0	0/0	25/0	0/0
D	35	0/-3	0/0	0/0	0/0	37/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (7)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB. FR-TO	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
		FROM	TO				
E-B	-227/0	0.0	0.0	0.11 (4)		7.81	
A-B	0/28	-91.8	-91.8	0.12 (1)		10.00	
B-C	-9/9	-91.8	-91.8	0.08 (4)		10.00	
E-F	0/0	-18.5	-18.5	0.14 (4)		10.00	
F-G	0/0	-18.5	-18.5	0.14 (4)		10.00	
G-D	0/0	-18.5	-18.5	0.14 (4)		10.00	

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11-4	7	1	12	FRONT	VERT	TOTAL	---	C1
G	3-11-4	1	1	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2010
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.04")

CSI: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4), WB=0.09/1.00 (A-B:0), SB=0.09/1.00 (A-B:1)

DOL LUMBER=0.99 NAIL=0.99 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006989

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408089	C32	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 09:25:32 2020 Page 1
ID:DMCubINVR6TstFoe31v8l_zns1l-svsgStq4hZ5iVOnk11ZXaPzriJK90IUzVX03fzNECn

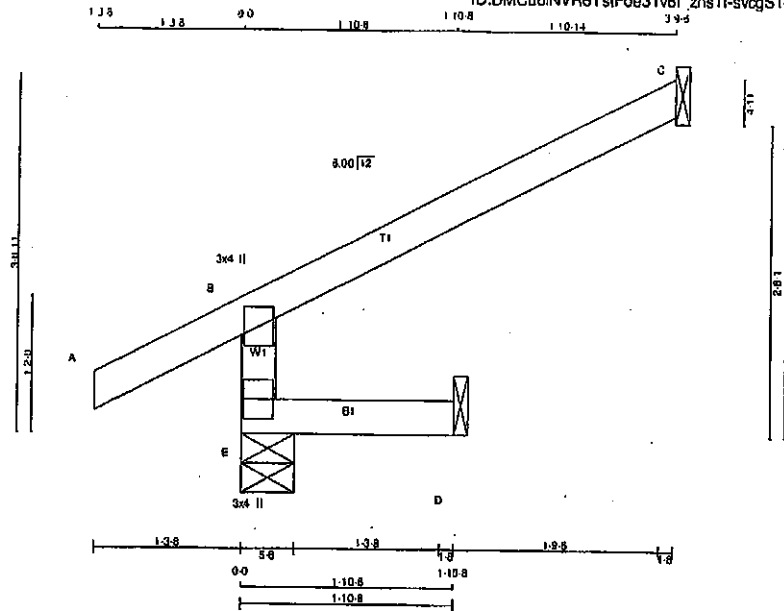

Scale = 1/8" = 1'-0"

<u>LUMBER</u>			
N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
E	361	0	361	0	5-8	5-8
C	130	0	130	0	1-8	1-8
D	16	0	17	0	1-8	1-8

SEE MTEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX. MIN. COMPONENT REACTIONS				
		SNOW	LIVE	PERM LIVE	WIND	DEAD
E	250	190 / 0	0 / 0	0 / 0	0 / 0	0 / 0
C	90	73 / 0	0 / 0	0 / 0	0 / 0	0 / 0
D	12	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS					WEBBS				
MEMB.	MAX. FACTORED (LBS)	FACTORED VERT. LOAD	LC1 (PLF)	MAX. CS1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM	TO			FR-TO			
E-B	-341 / 0	0.0	0.0	0.01 (4)	7.81				
A-B	0 / 28	-91.8	-91.8	0.13 (5)	10.00				
B-C	-19 / 0	-91.8	-91.8	0.22 (1)	6.25				
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 10 = 29 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CS1: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (A-B:0), SS1=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788
		1987 1650

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)

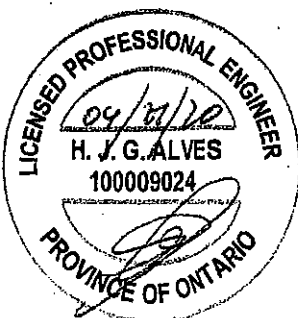

Structural component only
DWG# T-2006990

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408089	C33	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 09:25:33 2020 Page 1					
ID:DMCubINVR6TstFoe31v61_zns11-K5A2INnSIDZ7XMwbk4m7dW22jg3IKkj9HAb6zNECm					
Scale = 1/16"					

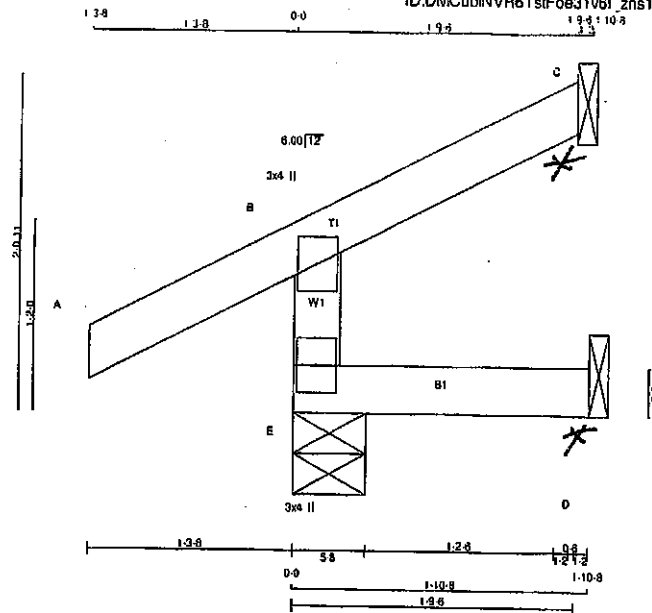

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	
CHORDS	2x4	DRY	No.2
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
E	271	0	271	0	5-8
C	44	0	44	0	5-8
D	8	0	17	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS		1ST CASE	MAX. MIN. COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	188	141.0	0.0	0.0	0.0	47.0	0.0
C	31	24.7	18.0	0.0	0.0	7.0	0.0
D	7	0.7	18.0	0.0	0.0	12.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		MAX. FACTORED	FACTORED	MEMB.	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	LC1 MAX	MEMB.	FORCE	MAX. FACTORED	MEMB.
	(LBS)	(PLF)	CSI (LC)		(LBS)	CSI (LC)	
FR-TO		FROM TO		LENGTH	FR-TO		
E-B	-244.0	0.0	0.0	0.04 (5)	7.81		
A-B	0.28	-91.8	-91.8	0.12 (1)	10.00		
B-C	-17.0	-91.8	-91.8	0.09 (1)	6.25		
E-D	0.0	-18.5	-18.5	0.04 (5)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 7 = 21 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19')
CALCULATED VERT. DEFL. (LL) = L/999 (0.00')
ALLOWABLE DEFL. (TL) = L/360 (0.19')
CALCULATED VERT. DEFL. (TL) = L/999 (0.00')

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5),
WB=0.00/1.00 (n/a:0), SS=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1887 788	1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.99)
JSI METAL= 0.07 (S) (INPUT = 1.00)

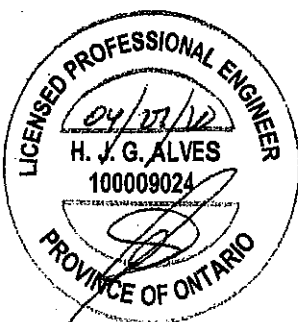

Structural component only
DWG# T-2008991

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:

- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1 1/2" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.




Double-Shear Nailing Top View




Double-Shear Nailing Side View; Do not bend tab




Double-Shear Nailing Side View (available on some models)
U.S. Patent 5,803,580

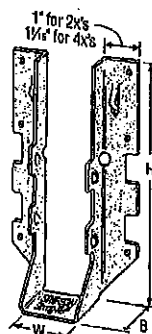


✓ LUS28




LU26L

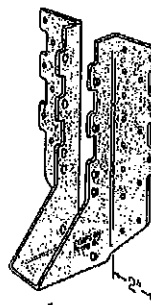


✓ HUS210
(HUS26, HUS28, and HHUS similar)



✓ HGUS28-2




✓ HHUS210-2



LJS26DS

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

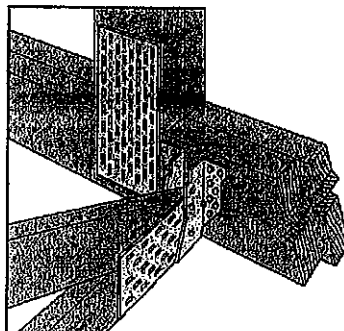

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

HHUS/HGUS

See Hanger Options Information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
$W < 2"$	Bevel or square cut	0.62 of table value	0.46 of table value
$2" < W < 6"$	Bevel cut	0.67 of table value	0.41 of table value
$2" < W < 6"$	Square cut	0.48 of table value	0.41 of table value
$W > 6"$	Bevel cut	0.75 of table value	0.41 of table value

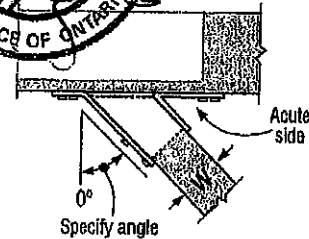

Top View HHUS Hanger
 Skewed Right
 (joist must be bevel cut)
 All joist nails installed on the
 outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ^s	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN	(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN
Single 2x Sizes											
LUS24	18	1 1/8	3 1/4	1 1/4	2 1/4	(4) 10d	(2) 10d	710 316	1625 723	845 287	1155 514
LU24L	22	1 1/8	3	1 1/4	2 1/4	(4) 10d	(2) 10d x 1 1/2"	360 160	1020 454	320 142	725 322
LU26L	22	1 1/8	5	1 1/4	4 1/4	(6) 10d	(4) 10d x 1 1/2"	720 320	1805 714	645 287	1140 507
LUS26	18	1 1/8	4 1/4	1 1/4	3 3/4	(4) 10d	(4) 10d	1420 632	2170 985	1290 574	1630 725
HUS28	18	1 1/8	5 3/4	3	3 1/8	(14) 16d	(6) 16d	2705 1180	4940 2197	2065 920	3875 1724
LJS26DS	18	1 1/8	5	3 1/2	4 1/4	(16) 16d	(6) 16d	2055 914	4285 1807	1480 649	4115 1831
HGUS26	12	1 1/8	5 3/4	5	4 1/4	(20) 16d	(8) 16d	2685 1196	6625 2951	2685 1196	6700 2535
LU28L	20	1 1/8	6 3/4	1 1/4	5 3/4	(8) 10d	(6) 10d x 1 1/2"	1140 507	2185 972	1020 454	1550 889
LUS28	18	1 1/8	6 1/4	1 1/4	3 3/4	(6) 10d	(4) 10d	1420 632	2520 1121	1290 574	1790 796
HUS28	16	1 1/8	7 1/8	3	6 1/8	(22) 18d	(8) 18d	3805 1604	5385 2386	2675 1190	4345 1933
HGUS28	12	1 1/8	7 1/8	5	6 1/8	(36) 16d	(12) 16d	3310 1474	7675 3419	3310 1474	6900 3073
LU210L	20	1 1/8	8	1 1/4	7 1/4	(10) 10d	(8) 10d x 1 1/2"	1140 607	2495 1110	1020 454	1770 787
LUS210	18	1 1/8	7 1/4	1 1/4	3 3/4	(8) 10d	(4) 10d	1420 632	2785 1239	1290 574	2210 983

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

SIMPSON
Strong-Tie

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _a ¹	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _g = 1.15)	(K _g = 1.00)	(K _g = 1.15)	(K _g = 1.00)
								lb.	lb.	lb.	lb.
								kN	kN	kN	kN
Double 2x Sizes											
LUS24-2	18	3 1/8	3 1/8	2	1 1/8	(4) 16d	(2) 16d	835	2020	590	1435
								3.71	8.99	2.62	6.38
SS LUS26-2	18	3 1/8	4 1/8	2	4	(4) 16d	(4) 16d	1720	2595	1545	1920
								7.65	11.54	6.87	8.64
HHUS26-2	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	2850	7335	2065	5205
								12.68	32.83	9.20	23.15
HGUS26-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
SS LUS28-2	18	3 1/8	7	2	4	(6) 16d	(4) 16d	1720	3325	1545	2575
								7.65	14.79	6.87	11.45
HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765	8940	2675	6345
								16.75	39.77	11.90	28.22
HGUS28-2	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
SS LUS210-2	18	3 1/8	9	2	6	(8) 16d	(8) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d	4670	9660	4235	7000
								20.77	42.97	18.84	31.14
HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-3	12	4 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	4670	9660	4235	6805
								20.77	43.02	18.84	30.51
HGUS210-3	12	4 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
Quadruple 2x Sizes											
HGUS26-4	12	6 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-4	14	6 1/8	8 1/8	3	7 1/8	(30) 16d	(10) 16d	4670	10155	4235	7210
								20.77	45.17	18.84	32.07
HGUS210-4	12	6 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
HGUS212-4	12	6 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10845
								33.98	66.70	24.13	47.35
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80
4x Sizes											
LUS46	18	3 1/8	4 1/8	2	3 1/8	(4) 16d	(4) 16d	1720	2595	1545	1920
								7.65	11.54	6.87	8.64
HHUS46	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	2540	7335	2065	5205
								11.30	32.83	9.20	23.15
HGUS46	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
LUS48	18	3 1/8	6 1/8	2	3 1/8	(6) 16d	(4) 16d	1720	3325	1545	2575
								7.65	14.79	6.87	11.45
HHUS48	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765	8940	2675	6345
								16.75	39.77	11.90	28.22
HGUS48	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
LUS410	18	3 1/8	8 1/8	2	5 1/8	(8) 16d	(8) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HGUS410	12	3 1/8	9	4	8 1/8	(46) 16d	(16) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
HGUS412	12	3 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10845
								33.98	66.70	24.13	47.35
HGUS414	12	3 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80



Plated Truss Connectors

See footnotes
on p. 258.

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

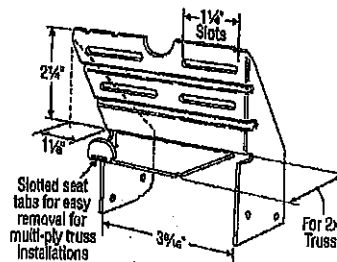


TC24
U.S. Patent 4,932,173

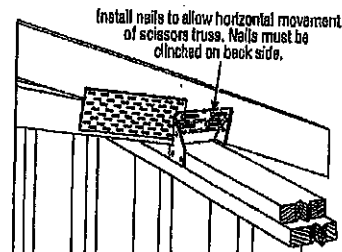


Typical TC24 Installation

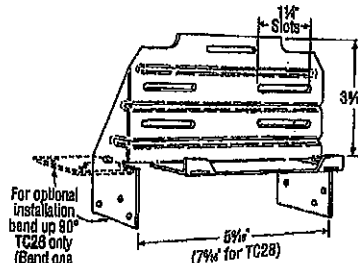

TC26
(TC28 Similar)

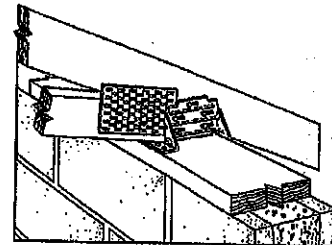

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer
(8", 10", 12" Wall Installation Similar)

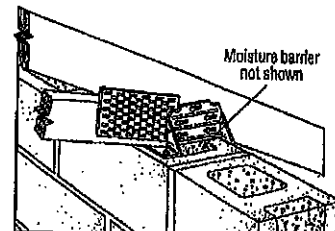

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift ($K_c=1.15$)	Uplift ($K_c=1.15$)
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift ($K_c=1.15$)	Uplift ($K_c=1.15$)
TC26	(5) 10d	(6) 10d x 1 1/2"	810	660
	(5) 10d	(6) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.

2. Grout strength is 15 MPa minimum.

3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.

4. TC26 fastened to grouted concrete block with (5) - 3/8" x 2 1/4" Titen screws has a factored uplift resistance of 275 lb.



(800) 999-5099
strongtie.com

H/TSP

SIMPSON

Strong-Tie

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_D = 1.15$)					
		To Rafters/ Truss	To Plates	To Studs	D.Fir-L			S-P-F		
					Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(6) 8d x 1 1/2"	(4) 8d	—	740	685	300.	680	485	215
					3.29	3.05	1.33	3.02	2.16	0.96
SS H2A	18	(5) 8d x 1 1/2"	(2) 8d x 1 1/2"	(5) 8d x 1 1/2"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
					3.68	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	265	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	870	—	990	475	—
					6.18	2.88	—	4.40	2.11	—
SS H8*	18	(5) 10d x 1 1/2"	(5) 10d x 1 1/2"	—	1120	—	—	1025	—	—
					4.98	—	—	4.66	—	—
SS H10A*	18	(9) 10d x 1 1/2"	(9) 10d x 1 1/2"	—	1735	795	410	1505	585	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1 1/2"	(9) 10d x 1 1/2"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1 1/2"	(9) 10d x 1 1/2"	—	1835	1275	430	1845	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S*	18	(8) 8d x 1 1/2"	(8) 8d x 1 1/2"	(8) 8d	1465	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2 1/2"	(6) 16d x 2 1/2"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1 1/2"	(13) 8d	—	2390	855	320	1805	610	230
		[2] (12) 8d x 1 1/2"	(15) 8d	—	10.63	3.80	1.42	8.03	2.71	1.02
					2390	855	320	1805	610	230
TSP	18	(9) 10d x 1 1/2"	(6) 10d x 1 1/2"	—	10.63	3.80	1.42	8.03	2.71	1.02
					1295	440	—	920	310	—
					5.78	1.96	—	4.09	1.38	—
		(9) 10d x 1 1/2"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.98	—	4.92	1.38	—

- Factored resistances have been increased 16% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2 1/2" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNF ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastener to a 2x4 truss bottom chord and double top plates using (5) 8d x 1 1/2" nails into the top plates and (3) 8d x 1 1/2" nails into the lowest three flange holes into the truss bottom chord is 485 lb. (2.20 kN).
- Nails: 16d x 2 1/2" = 0.162" dia. x 2 1/2" long, 10d = 0.148" dia. x 3" long, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long, 8d = 0.131" dia. x 2 1/2" long, 8d x 1 1/2" = 0.131" dia. x 1 1/2" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:


1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

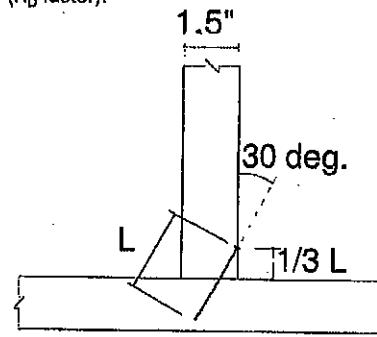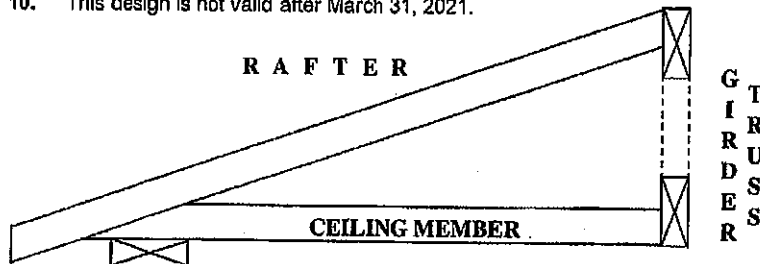

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to wind or earthquake load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

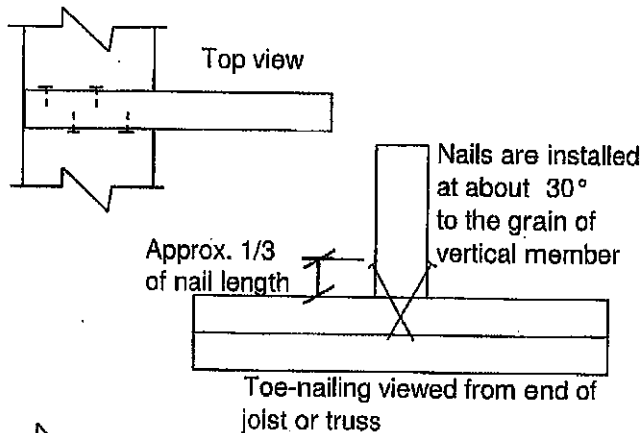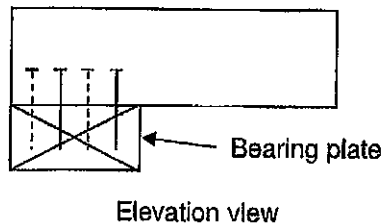

Toe-nailing on 2x4 Bearing Plate

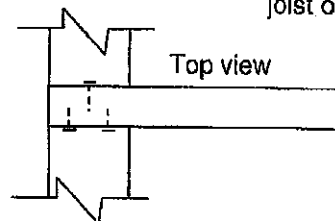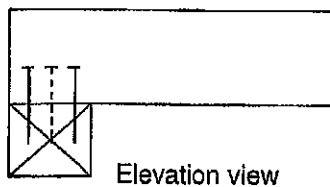

MiTek


MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/8" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

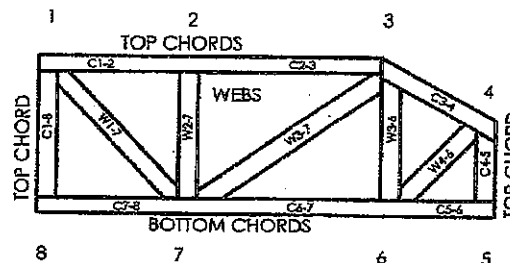

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L 10319-L 13270-L 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MII-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss of each joint and embed fully. Knots and wane of joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

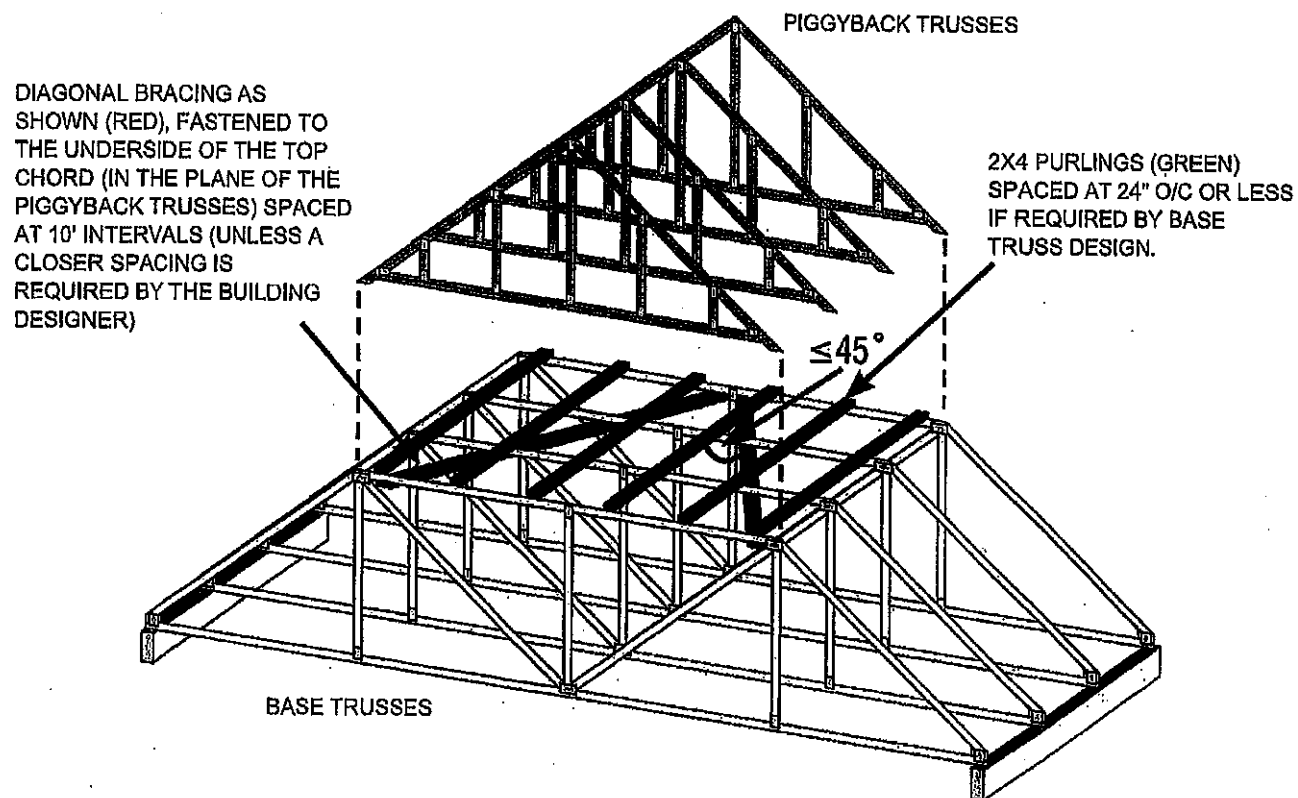


NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdiction.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufacturer's responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet M117473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1800218

Feb 09, 2018