

CONSTRUCTION NOTES (Unless otherwise noted)

ALL CONSTRUCTION TO ADHERE TO THESE PLANS AND SPEC'S AND TO CONFORM TO THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE CODES AND AUTHORITIES HAVING JURISDICTION. THESE REQUIREMENTS ARE TO BE TAKEN AS MINIMUM SPECIFICATIONS. ONT. REG. 332/12-2012 OBC.

1. ROOF CONSTRUCTION

NO.210 (10.25kg/m²) ASPHALT SHINGLES, 10mm (3/8") PLYWOOD SHEATHING WITH "H" CUPS, APPROVED WOOD TRUSSES @ 610mm (24") O.C. MAX. APPROVED EAVES PROTECTION TO EXTEND 900mm (3'-0") FROM EDGE OF ROOF AND MIN. 300mm (12") BEYOND INNER FACE OF EXTERIOR WALL. (EAVES PROTECTION NOT REQ'D FOR ROOF SLOPES 8:12 OR GREATER) 38x89 (2"x4") TRUSS BRACING @ 1830mm (6'-0") O.C. AT BOTTOM CHORD, PERMAN. ALUM. EXTERIOR FINISH, PASCAL RAIL, & VENTED SOFFIT. PROVIDE ICE & WATER SHEET TO ALL ROOF/FALL SURFACES SUSCEPTIBLE TO ICE DAMMING. SHEATHING TO BE FASTENED 150 (6") c/c. ALONG EDGES & INTERMEDIATE SUPPORTS WHEN TRUSSES SPACED GREATER THAN 406 (16"). AIRTIGHT VENTILATION 1:300 OF INSULATED CEILING AREA WITH MIN. 25% AT EAVES & MIN. 25% AT RIDGE (OBC 9.19.1.2).

2. FRAME WALL CONSTRUCTION (2"x6") (SB-12-TABLE 3.1.1.2.A) SINGING AS PER ELEV. 19x38 (1"x2") VERTICAL WOOD FURRING, CONTIN. SHEATHING MEMBRANE, 11mm (7/16") EXT. TYPE SHEATHING OR OBC COMPLIANT EQUIVALENT, 38x140 (2"x6") STUDS @ 406mm (16") O.C., RSI 3.87 (R22) INSULATION AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm (1/2") INT. DRYWALL FINISH. SIDING TO BE MIN. 200mm (8") ABOVE FINISH GRADE. REFER TO OBC SB-12, CHAPTER 3 FOR REQUIRED MINIMUM THERMAL INSULATION REQUIREMENTS.

26. FRAME WALL CONSTRUCTION (2"x6") - GARAGE WALLS SINGING AS PER ELEV. 19x38 (1"x2") VERTICAL WOOD FURRING, CONTIN. SHEATHING MEMBRANE, 11mm (7/16") EXT. TYPE SHEATHING OR OBC COMPLIANT EQUIVALENT, 38x89 (2"x4") STUDS @ 406mm (16") O.C. (MAX. HEIGHT 3000mm (9'-10")), WITH APPR. DIAGONAL WALL BRACING. REFER TO NOTE 19 WHERE FLOOR EXIST ABOVE GARAGE. SIDING TO BE MIN. 200mm (8") ABOVE FINISH GRADE.

26. STUCCO WALL CONSTRUCTION (2"x6") (SB-12-TABLE 3.1.1.2.A) STUCCO CLADDING SYSTEM CONFORMING TO O.B.C. 9.27.1.1.(2) & 9.28 THAT EMPLOY A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 25mm (1") MIN. EXPANDED OR EXTRUDED RIGID POLYSTYRENE ON APPR. AIR/MOISTURE BARRIER ON 38x140 (2"x6") STUDS @ 406 (16") O.C., RSI 3.87 (R22) BATT INSUL., APPR. & MIL. POLYETHYLENE VAPOUR BARRIER, 13mm (1/2") GYPSUM BOARD INTERIOR FINISH. STUCCO TO BE MIN. 200 (8") ABOVE FINISH GRADE. REFER TO OBC SB-12, CHAPTER 3 FOR REQUIRED MINIMUM THERMAL INSULATION REQUIREMENTS.

26. STUCCO WALL CONSTRUCTION (2"x6") - GARAGE WALLS STUCCO CLADDING SYSTEM CONFORMING TO O.B.C. 9.27.1.1.(2) & 9.28 THAT EMPLOY A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 25mm (1") MIN. EXPANDED OR EXTRUDED RIGID POLYSTYRENE ON APPR. AIR/MOISTURE BARRIER ON 38x89 (2"x4") STUDS @ 406 (16") O.C. (MAX. HEIGHT 3000mm (9'-10")), WITH APPR. DIAGONAL WALL BRACING. REFER TO NOTE 19 WHERE FLOOR EXIST ABOVE GARAGE. STUCCO TO BE MIN. 200 (8") ABOVE FINISH GRADE.

26. WALLS ADJACENT TO ATTIC - NO CLADDING 11mm (7/16") EXT. TYPE SHEATHING OR OBC COMPLIANT EQUIVALENT, 38x140 (2"x6") STUDS @ 406mm (16") O.C., RSI 3.87 (R22) INSULATION AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm (1/2") INTERIOR DRYWALL FINISH. MID-HEIGHT BLOCKING REQ'D IF NO SHEATHING APPLIED. REFER TO OBC SB-12, CHAPTER 3 FOR ADDITIONAL THERMAL INSULATION REQUIREMENTS.

3. BRICK VENEER CONSTRUCTION (2"x6") (SB-12-TABLE 3.1.1.2.A) 90mm (4") FACE BRICK, 25mm (1") AIR SPACE, 22x180x76mm (7/8"x7"x6.03") GALV. METAL TIES @ 406mm (16") O.C. HORIZONTAL 610mm (24") O.C. VERTICAL. APPROVED SHEATHING PAPER, 11mm (7/16") EXTERIOR TYPE SHEATHING OR OBC COMPLIANT EQUIVALENT, 38x140 (2"x6") STUDS @ 406mm (16") O.C., RSI 3.87 (R22) INSULATION AND APPROVED VAPOUR BARRIER WITH APPROVED CONTIN. AIR BARRIER, 13mm (1/2") INT. DRYWALL FINISH. PROVIDE WEEP HOLES @ 600mm (32") O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER. BRICK TO BE MIN. 150mm (6") ABOVE FINISH GRADE. REFER TO OBC SB-12, CHAPTER 3 FOR REQUIRED MINIMUM THERMAL INSULATION REQUIREMENTS.

36. BRICK VENEER CONSTRUCTION (2"x6") - GARAGE WALLS 90mm (4") FACE BRICK, 25mm (1") AIR SPACE, 22x180x76mm (7/8"x7"x6.03") GALV. METAL TIES @ 406mm (16") O.C. HORIZONTAL 610mm (24") O.C. VERTICAL. APPROVED SHEATHING PAPER, 11mm (7/16") EXTERIOR TYPE SHEATHING OR OBC COMPLIANT EQUIVALENT, 38x89 (2"x4") STUDS @ 406mm (16") O.C. (MAX. HEIGHT 3000mm (9'-10")) WITH APPROVED DIAGONAL WALL BRACING. REFER TO NOTE 19 WHERE FLOOR EXIST ABOVE GARAGE. PROVIDE WEEP HOLES @ 600mm (32") O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER. BRICK TO BE MIN. 150mm (6") ABOVE FINISH GRADE.

36. STUCCO WALL CONSTRUCTION (2"x6") (SB-12-TABLE 3.1.1.2.A) STUCCO CLADDING SYSTEM CONFORMING TO O.B.C. 9.27.1.1.(2) & 9.28 THAT EMPLOY A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 25mm (1") MIN. EXPANDED OR EXTRUDED RIGID POLYSTYRENE ON APPR. CONTIN. AIR/MOISTURE BARRIER ON 38x140 (2"x6") STUDS @ 406mm (16") O.C., RSI 3.87 (R22) BATT INSUL., APPR. & MIL. POLYETHYLENE VAPOUR BARRIER, 13mm (1/2") GYPSUM BOARD INTERIOR FINISH. STUCCO TO BE MIN. 200 (8") ABOVE FINISH GRADE. REFER TO OBC SB-12, CHAPTER 3 FOR REQUIRED MINIMUM THERMAL INSULATION REQUIREMENTS.

INTERIOR STUD PARTITIONS

16. FOR BEARING PARTITIONS 38x89 (2"x4") @ 406mm (16") O.C. FOR 3 STOREYS AND 305mm (12") O.C. FOR 3 STOREYS, NON-BEARING PARTITIONS 38x69 (2"x4") @ 610mm (24") O.C. PROVIDE 38x89 (2"x4") BOTTOM PLATE AND 2/58x89 (2"x4") TOP PLATE, 13mm (1/2") INT. DRYWALL BOTH SIDES OF STUDS, PROVIDE 38x140 (2"x6") STUDS/PLATES WHERE NOTED.

16. FOUNDATION WALL/FOOTINGS: (9.15.3, 9.15.4, 9.15.2, 9.14.1.1, 21.20) 200mm (8") POURED CONC. FDN. WALL 150Pa (2200psi) WITH BITUMINOUS DAMPPROOFING AND DRAINAGE LAYER. DRAINAGE LAYER REQ'D WHEN BASEMENT INSUL. EXTENDS 900 (2'-11") BELOW FIN. GRADE. DRAINAGE LAYER IS NOT REQ'D IF FOUNDATION WALL IS WATERPROOFED MAXIMUM FOUR HEIGHT 2300 (7'-10") ON 500x155 (2"x6") CONTINUOUS KEYED CONC. FTG. BRACE FDN. WALL PRIOR TO BACKFILLING. ALL FOOTINGS SHALL REST ON NATURAL UNDISTURBED SOIL OR COMPACTED ENGINEERED FILL.

STRIP FOOTINGS - FOR TOWNHOUSES FOR STRIP FOOTING SIZES REFER TO BLOCK FOUNDATION PLAN. ASSUMED 120 KPa (16 p.s.i.) SOIL BEARING CAPACITY FOR TOWNHOUSES, TO BE VERIFIED ON SITE.

-MAXIMUM FLOOR LIVE LOAD OF 2.4KPa (50psf) PER FLOOR. -REFER TO SOILS REPORT FOR SOIL CONDITIONS AND BEARING CAPACITY.

6. FOUNDATION DRAINAGE OBC 9.14.2 & 9.14.3 100mm (4") DIA. FOUNDATION DRAINAGE TILE 150mm (6") CRUSHED STONE OVER AND AROUND DRAINAGE TILES.

7. BASEMENT SLAB OBC 9.15.6(1)(b), 9.15.4.6(1), 9.25.3.3(1b) 80mm (3") MIN. 25MPa (3600psi) CONC. SLAB ON 100mm (4") COARSE GRANULAR FILL, OR 200Pa (3000psi) CONC. SLAB ON DAMPPROOFING BELOW SLAB. UNDER SLAB INSULATION PER SB-12, 3.1.1.7(5)(6) WHERE REQ'D. ALL SLAB JOINTS & PENETRATIONS TO BE SEALED TO MAINTAIN AIR BARRIER.

8. WOOD SUBFLOORS (SEE OBC 9.23.14 & 9.30.2.1) -19mm (3/4") MIN. T & G SUBFLOOR UNDER GROUND FLOOR FINISH FLOOR. 16mm (5/8") T&G SUBFLOOR UNDER SECOND FLOOR FINISH FLOOR. 16mm (5/8") PANEL-TYPE UNDERLAY FOR CERAMIC TILE APPLICATION. 6mm (1/4") PANEL-TYPE UNDERLAYMENT UNDER RESILIENT & PARQUET FLOORING.

9. ATTIC INSULATION (SB-12-TABLE 3.1.1.2.A) (SB-12-3.1.1.8) RSI 10.56 (R60) BLOWN IN ROOF INSULATION AND APPROVED VAPOUR BARRIER, 16mm (5/8") INT. DRYWALL FINISH OR APPROVED EQUAL RSI 3.52 (R20) MIN. ABOVE INNER SURFACE OF EXTERIOR WALL.

10. ALL STAIRS/EXTERIOR STAIRS - OBC 9.8 - UNIFORM RISE -5mm (1/4") MAX BETWEEN ADJACENT TREADS OR LANDINGS -10mm (1/2") MAX BETWEEN TALLEST & SHORTEST RISE IN FLIGHT

MAX. RISE = 200 (7'-7/8") MIN. RUN = 210 (8'-1/4") MIN. TREAD = 235 (9'-1/4") MAX. NOSING = 25 (1") MIN. HEADROOM = 1950 (6'-5") RAIL @ LANDING = 900 (2'-11") RAIL @ STAIR = 865 (2'-10") TO 965 (3'-2") MIN. STAIR WIDTH = 860 (2'-10")

FOR CURVED STAIRS MIN. RUN = 150 (6") MIN. AVG. RUN = 200 (8") MIN. HEADROOM = 1950 (6'-5")

11. FINISHED BUILDING ON POCKETS SPACED MAXIMUM 100mm (4") BETWEEN PICKETS. CLEARANCE BETWEEN HANDRAIL AND SURFACE BEHIND IT TO BE 53 (2") MIN. HANDRAILS TO BE CONTINUOUS EXCEPT FOR NEVEL POST AT CHANGES OF DIRECTION.

INTERIOR GUARDS - OBC 9.8.8 - INTERIOR GUARDS 900mm (2'-11") MIN. HIGH 900mm (36") HIGH GUARD WHERE DISTANCE FROM FURCH TO FIN. GRADE IS LESS THAN 1600mm (7'-11"). 1070mm (42") HIGH GUARD IS REQUIRED WHERE DISTANCE EXCEEDS 1600mm (7'-11").

SILL PLATE ANCHORAGE 38x89 (2"x4") SILL PLATE WITH 13mm (1/2") DIA. ANCHOR BOLTS 200mm (8") LONG, EXTERIOR MIN. 150mm (6") INTO CONC. @ 2400mm (7'-10") O.C., CALCULING OR 25 (1") MIN. MINERAL WOOL BETWEEN PLATE AND TOP OF FDN. WALL. USE NON-SHRINK GROUT TO LEVEL SILL PLATE WHEN REQUIRED.

13. BASEMENT INSULATION (SB-12-3.1.1.7, 9.25.2.3, 9.13.2.6) FOUNDATION WALLS ENVELOPING HEATED SPACE SHALL BE INSULATED FROM THE UNDERSIDE OF THE SUBFLOOR TO NOT MORE THAN 200mm (8") ABOVE THE FINISHED FLOOR & NO CLOSER THAN 50mm (2") OF THE BASEMENT SLAB. RSI 3.52 (R20) BLANKET INSULATION TO HAVE APPROVED VAPOUR BARRIER RECOMMEND DAMPPROOF WITH BUILDING PAPER BETWEEN THE FOUNDATION WALL AND INSULATION UP TO GRADE LEVEL. NOTE: FULL HEIGHT INSULATION AT COLD CELLAR WALLS. AIR BARRIER TO BE SEALED TO FOUNDATION WALL WITH CAULKING. CONTINUOUS INSULATION (6) IS NOT TO BE INTERRUPTED BY FRAMING.

14. BASEMENT BEARING STUD PARTITION 38x89 (2"x4") STUDS @ 406mm (16") O.C. 38x89 (2"x4") SILL PLATE ON DAMPPROOFING MATERIAL, 13mm (1/2") DIA. ANCHOR BOLTS 200mm (8") LONG, EMBEDDED MIN. 100mm (4") INTO CONC. @ 2400mm (7'-10") O.C. 100mm (4") HIGH CONC. CURB ON 355x155 (12"x6") CONC. FOOTING. ADD HORIZ. BLOCKING AT MID-HEIGHT IF WALL IS UNFINISHED.

15. STEEL BASEMENT COLUMN (SEE OBC 9.13.3.3) 69mm (3-1/2") DIA x 478mm (18.8") STL. COL. WITH A MIN. CAPACITY OF 102.8kN (24,000lbs) WITH 150x150x5 (6"x6"x3/8") STL. TOP & BOTTOM PLATE.

16. STEEL COLUMN 90mm (3-1/2") DIA x 478mm (18.8") STL. COL. WITH 100x100x6 (4"x4"x1/4") TOP & BOTTOM PLATES. FIELD WELD BOTTOM PLATE TO 100x250x12.5 (4"x10"x1/2") BASE PLATE C/W 2-12mm (1/2") DIA. x 360mm (14") LONG 50mm (2") HOOD ANCHORS (24x12x1/2) IN COLUMN TO STUD WALL WITH 2-32x3.175 (24x12x1/2) STL. STRAP WELDED TO COLUMN AND FASTENED TO STUD WALL WITH 2-32x3.175 (1/4"x1/2") SCREWS MANUF. BY SIMPSON STRONG TIE.

CONCRETE PLASTER

16. BEAM POCKET OF 200x200 (8"x8") POURED CONC. NB WALLS. MIN. BEARING 90mm (3-1/2")

17. 19x38 (1"x2") CONTINUOUS WOOD STRAPPING BOTH SIDES OF STEEL BEAM. (OBC 9.23.3.3(3c))

18. GARAGE SLAB 100mm (4") 32MPa (4640psi) CONC. SLAB WITH 5-BE AIR ENTRAINMENT OR OPTIONAL 100 (4") COARSE GRANULAR FILL WITH COMPACTED SUB-BASE OR COMPACTED NATIVE FILL. SLOPE TO FRONT (EXTERIOR) AT 1% MIN.

19. INTERIOR GARAGE WALLS & CEILING (SB-12-TABLE 3.1.1.2.A) 13mm (1/2") GYPSUM BOARD ON WALL AND CEILING BETWEEN HOUSE AND GARAGE. RSI 3.87 (R22) IN WALLS, RSI 5.46 (R31) IN CEILING. TIE AND SEAL ALL JOINTS AIRTIGHT PER O.B.C. 9.15.9.16. REFER TO SB-12, TABLE 3.1.1.2.A. FOR REQUIRED THERMAL INSULATION.

20. DOOR AND FRAME GASPROOFED. DOOR EQUIPPED WITH SELF CLOSING DEVICE AND WEATHERSTRIPPING PER OBC 9.10.13.15.

EXTERIOR STEP PRECAST CONCRETE STEP OR WOOD STEP WHERE NOT EXPOSED TO WEATHER. MAX. RISE 200mm (7'-7/8") MIN. TREAD 250mm (9'-27/32"). SEE OBC 9.8.9.2, 9.8.9.3, & 9.8.10.

21. DRYER VENT (OBC 9.23.8.7) & 6.2.4.1.1 CAPPED DRYER EXHAUST VENT TO EXTERIOR. (USE 100mm (4") DIA. SMOOTH WALL VENT PIPE).

22. INSULATED ATTIC ACCESS (OBC 9.10.2.1 & 9.12.1.1) ATTIC ACCESS HATCH WITH MIN. DIMENSION OF 545x700mm (21'-1/2"x27'-1/2") & A MIN. AREA OF 0.32 SQ.M. (3.41 SQ.FT.) WITH WEATHERSTRIPPING. RSI 3.52 (R20) RIGID INSULATION BACKING. SEE OBC 9.8.9.2 & 9.8.10.

24. FIREPLACE CHIMNEYS - OBC 9.21 - TOP OF FIREPLACE CHIMNEY SHALL BE 913mm (3'-0") ABOVE THE HIGHEST POINT AT WHICH IT COMES IN CONTACT WITH THE ROOF AND 610mm (2'-0") ABOVE THE ROOF SURFACE WITHIN A HORIZ. DISTANCE OF 3050mm (10'-0") FROM THE CHIMNEY.

25. LINEN CLOSETS 4 SHELVES MIN. 350mm (14") DEEP.

26. MECHANICAL EXHAUST MECHANICAL EXHAUST FAN, VENTED TO EXTERIOR AS REQUIRED BY OBC 9.23.3.1 & 9.23.3.10.

27. STEEL BEARING PLATE FOR MASONRY WALLS 280x280x10 (11"x11"x3/8") STL. PLATE FOR STL BEAMS AND 280x280x12 (11"x11"x1/2") STL. PLATE FOR WOOD BEAMS. BEARING ON CONC. BLOCK PARTIALLY, ANCHORED WITH 2-19mm (3/4") x 200mm (8") LONG GALV. ANCHORS WITHIN SOLID BLOCK COURSE. LEVEL WITH NON-SHRINK GROUT.

27A. SOLID WOOD BEARING FOR WOOD STUD WALLS SOLID BEARING TO BE AT LEAST AS WIDE AS THE SUPPORTED MEMBER. SOLID WOOD BEARING COMPOSED OF BUILT-UP WOOD STUDS TO BE CONSTRUCTED IN ACCORDANCE WITH OBC 9.17.4.2(2).

28. CLASS "B" VENT U.L.C. RATED CLASS "B" VENT 610mm (2'-0") ABOVE THE POINT IN CONTACT WITH THE ROOF FOR SLOPES UP TO 9/12. REFER TO THE ONTARIO GAS UTILIZATION CODE.

29. BASEMENT WOOD POST (OBC 9.17.4.2) 3-38x140 (3-2"x6") BUILT-UP-POST ON METAL BASE SHOE ANCHORED TO CONC. WITH 12.7 DIA. BOLT. 408x408x203 (16"x16"x8") CONC. FTG. ON AS OTHERWISE SPECIFIED ON DRAWING.

30. STEPPED FOOTINGS (OBC 9.15.9.9) MIN. HORIZ. STEP = 600mm (24") MAX. VERT. STEP = 600mm (24")

31. SLAB ON GRADE MIN. 100mm (4") CONCRETE SLAB ON GRADE ON 100mm (4") COARSE GRANULAR FILL. REINFORCED WITH 6-6x102x12.5 MESH PLACED NEAR MID-DEPTH OF SLAB. CONC. STRENGTH 32 MPa (4640 psi) WITH 5-BE AIR ENTRAINMENT ON COMPACTED SUB-GRADE. UNDER SLAB INSULATION AS PER OBC SB-12, 3.1.1.7(5)(6) AND SB-12, TABLE 3.1.1.2.A. WHERE REQUIRED. ALL JOINTS & PENETRATIONS OF INTERIOR SLABS TO BE SEALED TO MAINTAIN AIR BARRIER.

LOOSE STEEL LINTELS	
L1 = 3-1/2" x 3-1/2" x 1/4" (90x90x6.0)	
L2 = 4" x 3-1/2" x 5/16" (100x90x6.0)	
L3 = 5" x 3-1/2" x 5/16" (125x90x6.0)	
L4 = 6" x 3-1/2" x 3/8" (150x90x10.0)	
L5 = 6" x 4" x 3/8" (150x100x10.0)	
L6 = 7" x 4" x 3/8" (180x100x10.0)	

LAMINATED VENEER LUMBER (LVL) BEAMS	
LVL1A = 1-1 3/4"x7 1/4" (1-45x184)	
LVL1 = 2-1 3/4"x7 1/4" (2-45x184)	
LVL2 = 3-1 3/4"x7 1/4" (3-45x184)	
LVL3 = 4-1 3/4"x7 1/4" (4-45x184)	
LVL4A = 1-1 3/4"x9 1/4" (1-45x235)	
LVL4 = 2-1 3/4"x9 1/4" (2-45x235)	
LVL5 = 3-1 3/4"x9 1/4" (3-45x235)	
LVL5A = 4-1 3/4"x9 1/4" (4-45x235)	
LVL6A = 1-1 3/4"x11 7/8" (1-45x300)	
LVL6 = 2-1 3/4"x11 7/8" (2-45x300)	
LVL7 = 3-1 3/4"x11 7/8" (3-45x300)	
LVL7A = 4-1 3/4"x11 7/8" (4-45x300)	
LVL8 = 2-1 3/4"x14" (2-45x356)	
LVL9 = 3-1 3/4"x14" (3-45x356)	

BRICK VENEER LINTELS	
WL1 = 3-1/2" x 3-1/2" x 1/4" (90x90x6.0)	
WL2 = 4" x 3-1/2" x 5/16" (102x89x7.9)	
WL3 = 5" x 3-1/2" x 5/16" (127x89x7.9)	
WL4 = 6" x 3-1/2" x 7/16" (152x89x11.0)	
WL5 = 6" x 4" x 7/16" (152x102x11.0)	
WL6 = 6" x 3-1/2" x 5/16" (127x89x7.9)	
WL7 = 6" x 3-1/2" x 5/16" (127x89x7.9)	
WL8 = 6" x 3-1/2" x 5/16" (127x89x7.9)	
WL9 = 6" x 4" x 7/16" (152x102x11.0)	

WOOD LINTELS AND BEAMS	
WB1 = 2-2"x8" (2-38x184) SPR. No.2	
WB2 = 3-2"x8" (3-38x184) SPR. No.2	
WB3 = 2-2"x10" (2-38x235) SPR. No.2	
WB4 = 3-2"x10" (3-38x235) SPR. No.2	
WB5 = 2-2"x12" (2-38x286) SPR. No.2	
WB6 = 3-2"x12" (3-38x286) SPR. No.2	
WB7 = 5-2"x12" (5-38x286) SPR. No.2	
WB11 = 4-2"x12" (4-38x235) SPR. No.2	
WB12 = 4-2"x12" (4-38x286) SPR. No.2	

DOOR SCHEDULE	
NO.	DESCRIPTION
1	2'-10" x 6'-8" 6'-0" INSULATED ENTRANCE DOOR
2	2'-8" x 6'-8" 6'-0" INSULATED FRONT DOOR
3	2'-8" x 6'-8" 6'-0" WOOD & GLASS DOOR
4	2'-8" x 6'-8" 6'-0" EXTERIOR SLAB DOOR
5	2'-8" x 6'-8" 6'-0" INTERIOR SLAB DOOR
6	2'-8" x 6'-8" 6'-0" INTERIOR SLAB DOOR
7	1'-6" x 6'-8" 6'-0" INTERIOR SLAB DOOR

32. DIRECT VENTING GAS FURNACE VENT DIRECT VENT FURNACE TERMINAL MIN. 300mm (36") FROM A GAS REGULATOR, MIN. 300mm (12") ABOVE FIN. GRADE, FROM ALL OPENINGS, EXHAUST AND INTAKE VENTS. INTAKE TO BE A MIN. OF 1830mm (6'-0") FROM ALL EXHAUST TERMINALS. REFER TO GAS UTILIZATION CODE. ALL AIR INTAKES SHALL BE LOCATED SO THAT THEY ARE SEPARATED FROM KITCHEN EXHAUST BY 3.0M IN COMPLIANCE WITH O.B.C. DIV.-B TABLE 6.2.3.12.

33. DIRECT VENTING GAS FIREPLACE VENT DIRECT VENT GAS FIREPLACE VENT TO BE A MINIMUM 300mm (12") FROM ANY OPENING AND ABOVE FIN. GRADE. REFER TO GAS UTILIZATION CODE.

34. JOIST STRAPPING AND BRIDGING (SEE OBC 9.23.9.4) 16mm (5/8") T & G SUBFLOOR ON WOOD FLOOR JOISTS. FOR CERAMIC TILE APPLICATION (SEE OBC 9.30.6. *) 6mm (1/4") PANEL TYPE UNDERLAY UNDER RESILIENT & PARQUET FLOORING. (SEE OBC 9.30.2.4)

FLOOR JOISTS WITH SPANS OVER 2100mm (6'-11") TO BE BRIDGED WITH 38x38 (2"x2") CROSS BRACING OR SOLID BLOCKING @ 2100mm (6'-11") O.C. MAX. AND WHERE SPECIFIED BY JOIST TABLES A-1 OR A-2 STRAPPING SHALL BE 19x64 (1"x3") @ 2100mm (6'-11") O.C. UNLESS A PANEL TYPE CEILING FINISH IS APPLIED. (SEE OBC 9.23.9.4. *)

35. EXPOSED BUILDING FACE - OBC 9.10.15 EXTERIOR WALLS TO HAVE A FIRE RESISTANCE RATING OF NOT LESS THAN 45 min. WHERE LIMITING DISTANCE (LD) IS LESS THAN 1.2M (3'-11"). WHERE THE LD IS LESS THAN 600mm (1'-11") THE EXPOSING FACE SHALL BE CLAD IN NON-COMBUSTIBLE MATERIAL. SEE ELEVATIONS FOR ADDITIONAL NOTES.

36. COLD CELLAR PORCH SLAB (OBC 9.39.1) FLOOR 2500 mm (8'-2") PORCH DEPTH (SHORTEST DIM.), 125mm (4 7/8") 32MPa (4640psi) CONC. SLAB WITH 5-BE AIR ENTRAINMENT. REIN. WITH 10M BARS @ 200mm (7 7/8") O.C. EACH WAY IN BOTTOM THIRD OF SLAB, 600x600 (23 5/8" x 23 5/8") 10M DOWELS @ 600mm (23 5/8") O.C. ANCHORED IN PERMETER FDTN. WALLS. SLOPE SLAB MIN. 1.0% FROM DOOR. SLAB TO HAVE MIN 75mm (3") BEARING ON FDN. WALLS. PROVIDE (1) LINTELS OVER CELLAR DOOR AND WITH 100mm (4") END BEARING.

37. BRICK CHECK THE FDN. WALL SHALL NOT BE REDUCED TO LESS THAN 90mm (3-1/2") THICK TO A MAX. DEPTH OF 600mm (26") AND SHALL BE TIED TO THE FACING MATERIAL WITH METAL TIES SPACED 200mm (8") O.C. VERTICALLY AND 900mm (36") O.C. HORIZONTALLY. FILL SPACE BETWEEN WALL AND FACING SOLID WITH MORTAR.

38. CONVENTIONAL ROOF FRAMING (2.0KPa SNOW LOAD) 38x140 (2"x6") RAFTERS @ 406mm (16") O.C. FOR MAX 11'-7" SPAN, 38x184 (2"x8") RIDGE BOARD, 38x89 (2"x4") COLLAR TIES AT MIDSPANS. CEILING JOISTS TO BE 38x89 (2"x4") @ 406mm (16") O.C. FOR MAX. 2830mm (9'-3") SPAN & 38x140 (2"x6") @ 406 (16") O.C. FOR MAX. 4450mm (14'-7") SPAN. RAFTERS FOR BUILT-UP ROOF TO BE 38x89 (2"x4") @ 610mm (24") O.C. WITH A 38x89 (2"x4") CENTRE POST TO THE TRUSS BELOW, LATERALLY BRACED @ 1800mm (6'-0") O.C. VERTICALLY.

39. TWO STOREY VOLUME SPACES -FOR A MAXIMUM 5490 mm (18'-0") HEIGHT AND MAXIMUM SUPPORTED ROOF TRUSS LENGTH OF 6.0m, PROVIDE 2-38x140 (2"x6") SPR#2 CONTIN. STUDS @ 305mm (12") O.C. (TRIPLE UP AT EVERY THIRD DOUBLE STUD FOR BRICK WALLS) C/W 9.6 (3/8") THICK EXT. PLYWOOD SHEATHING. PROVIDE SOLID WOOD BLOCKING BETWEEN WOOD STUDS @ 1220 mm (4'-0") O.C. VERTICALLY. -FOR WALLS WITH HORIZ. DISTANCES NOT EXCEEDING 2900 mm (9'-6"), PROVIDE 38x140 (2"x6") STUDS @ 406 (16") O.C. WITH CONTINUOUS 2-38x140 (2"x6") TOP PLATES & 1-38x140 (1"x6") BOTTOM PLATE & MINIMUM OF 3-38x184 (3"x2") CONT. HEADER AT GRID. CEILING LEVEL TOE-NAILLED & GLUED AT TOP, BOTTOM PLATES AND HEADERS.


40. EXPOSED FLOOR TO EXTERIOR (SB-12-TABLE 3.1.1.2.A) PROVIDE RSI 5.46 (R31) INSULATION, APPROVED VAPOUR BARRIER AND CONTINUOUS AIR BARRIER, FINISHED SOFFIT.

41. PARTY WALLS TYPICAL 1 HOUR RATED PARTYWALL. REFER TO DETAILS FOR TYPE AND SPECIFICATIONS.


42. EXTERIOR WALLS FOR WALK-OUT CONDITIONS THE EXTERIOR BASEMENT STUD WALL TO BE 38x140 (2"x6") STUDS @ 406mm (16") O.C. OR 38x89 (2"x4") STUDS @ 305mm (12") O.C.

WINDOWS

- 1) MINIMUM BEDROOM WINDOW - OBC 9.9.10.1- AT LEAST ONE BEDROOM WINDOW ON A GIVEN FLOOR IS TO HAVE MIN. 0.35m² UNOBSTRUCTED GLAZED OR OPENABLE AREA WITH MIN. CLEAR WIDTH OF 380 mm (15-3/8")
- 2) WINDOW GUARDS - OBC 9.8.8.1(6) A GUARD IS REQUIRED WHERE THE TOP OF THE WINDOW SILL IS LOCATED LESS THAN 46

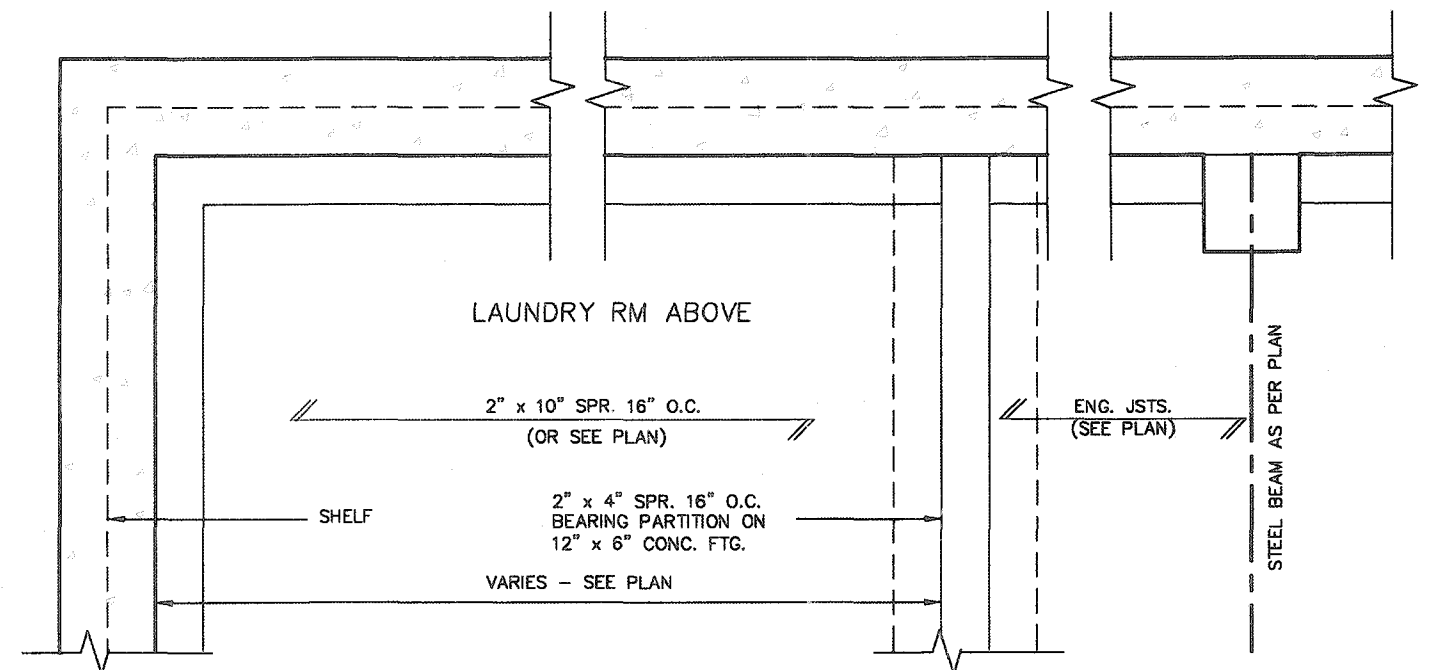

PARTIAL FOUNDATION PLAN

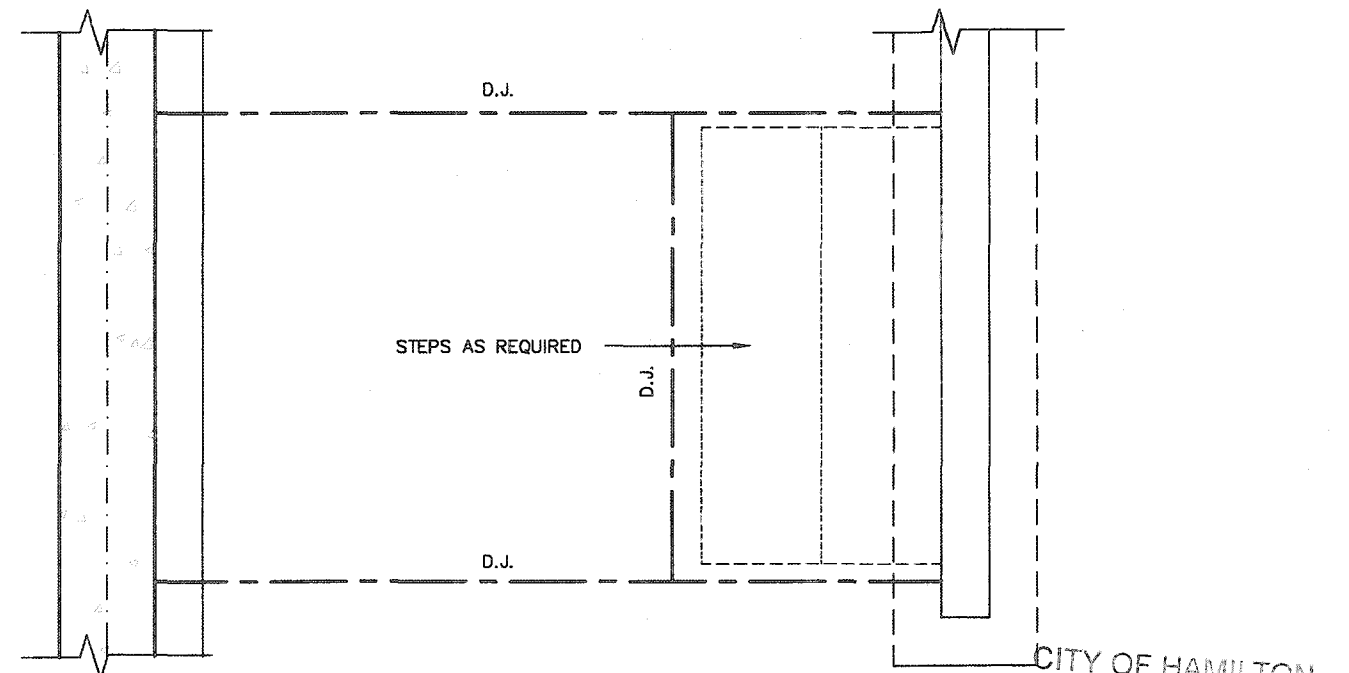


CITY OF HAMILTON
Building Division

Permit No. 21-102430

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by
Kenn Smith Feb. 29, 2021
FOR CHIEF BUILDING OFFICIAL DATE

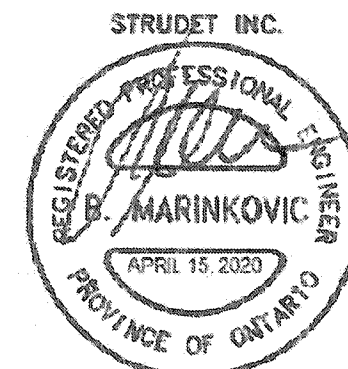

FOR STRUCTURE ONLY




FOR STRUCTURE ONLY

FOR STRUCTURE ONLY

2012 CODE
PACKAGE A1

[illegible]

All drawings, specifications, related documents and design are the copyright property of VAB DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VAB DESIGN's written permission.

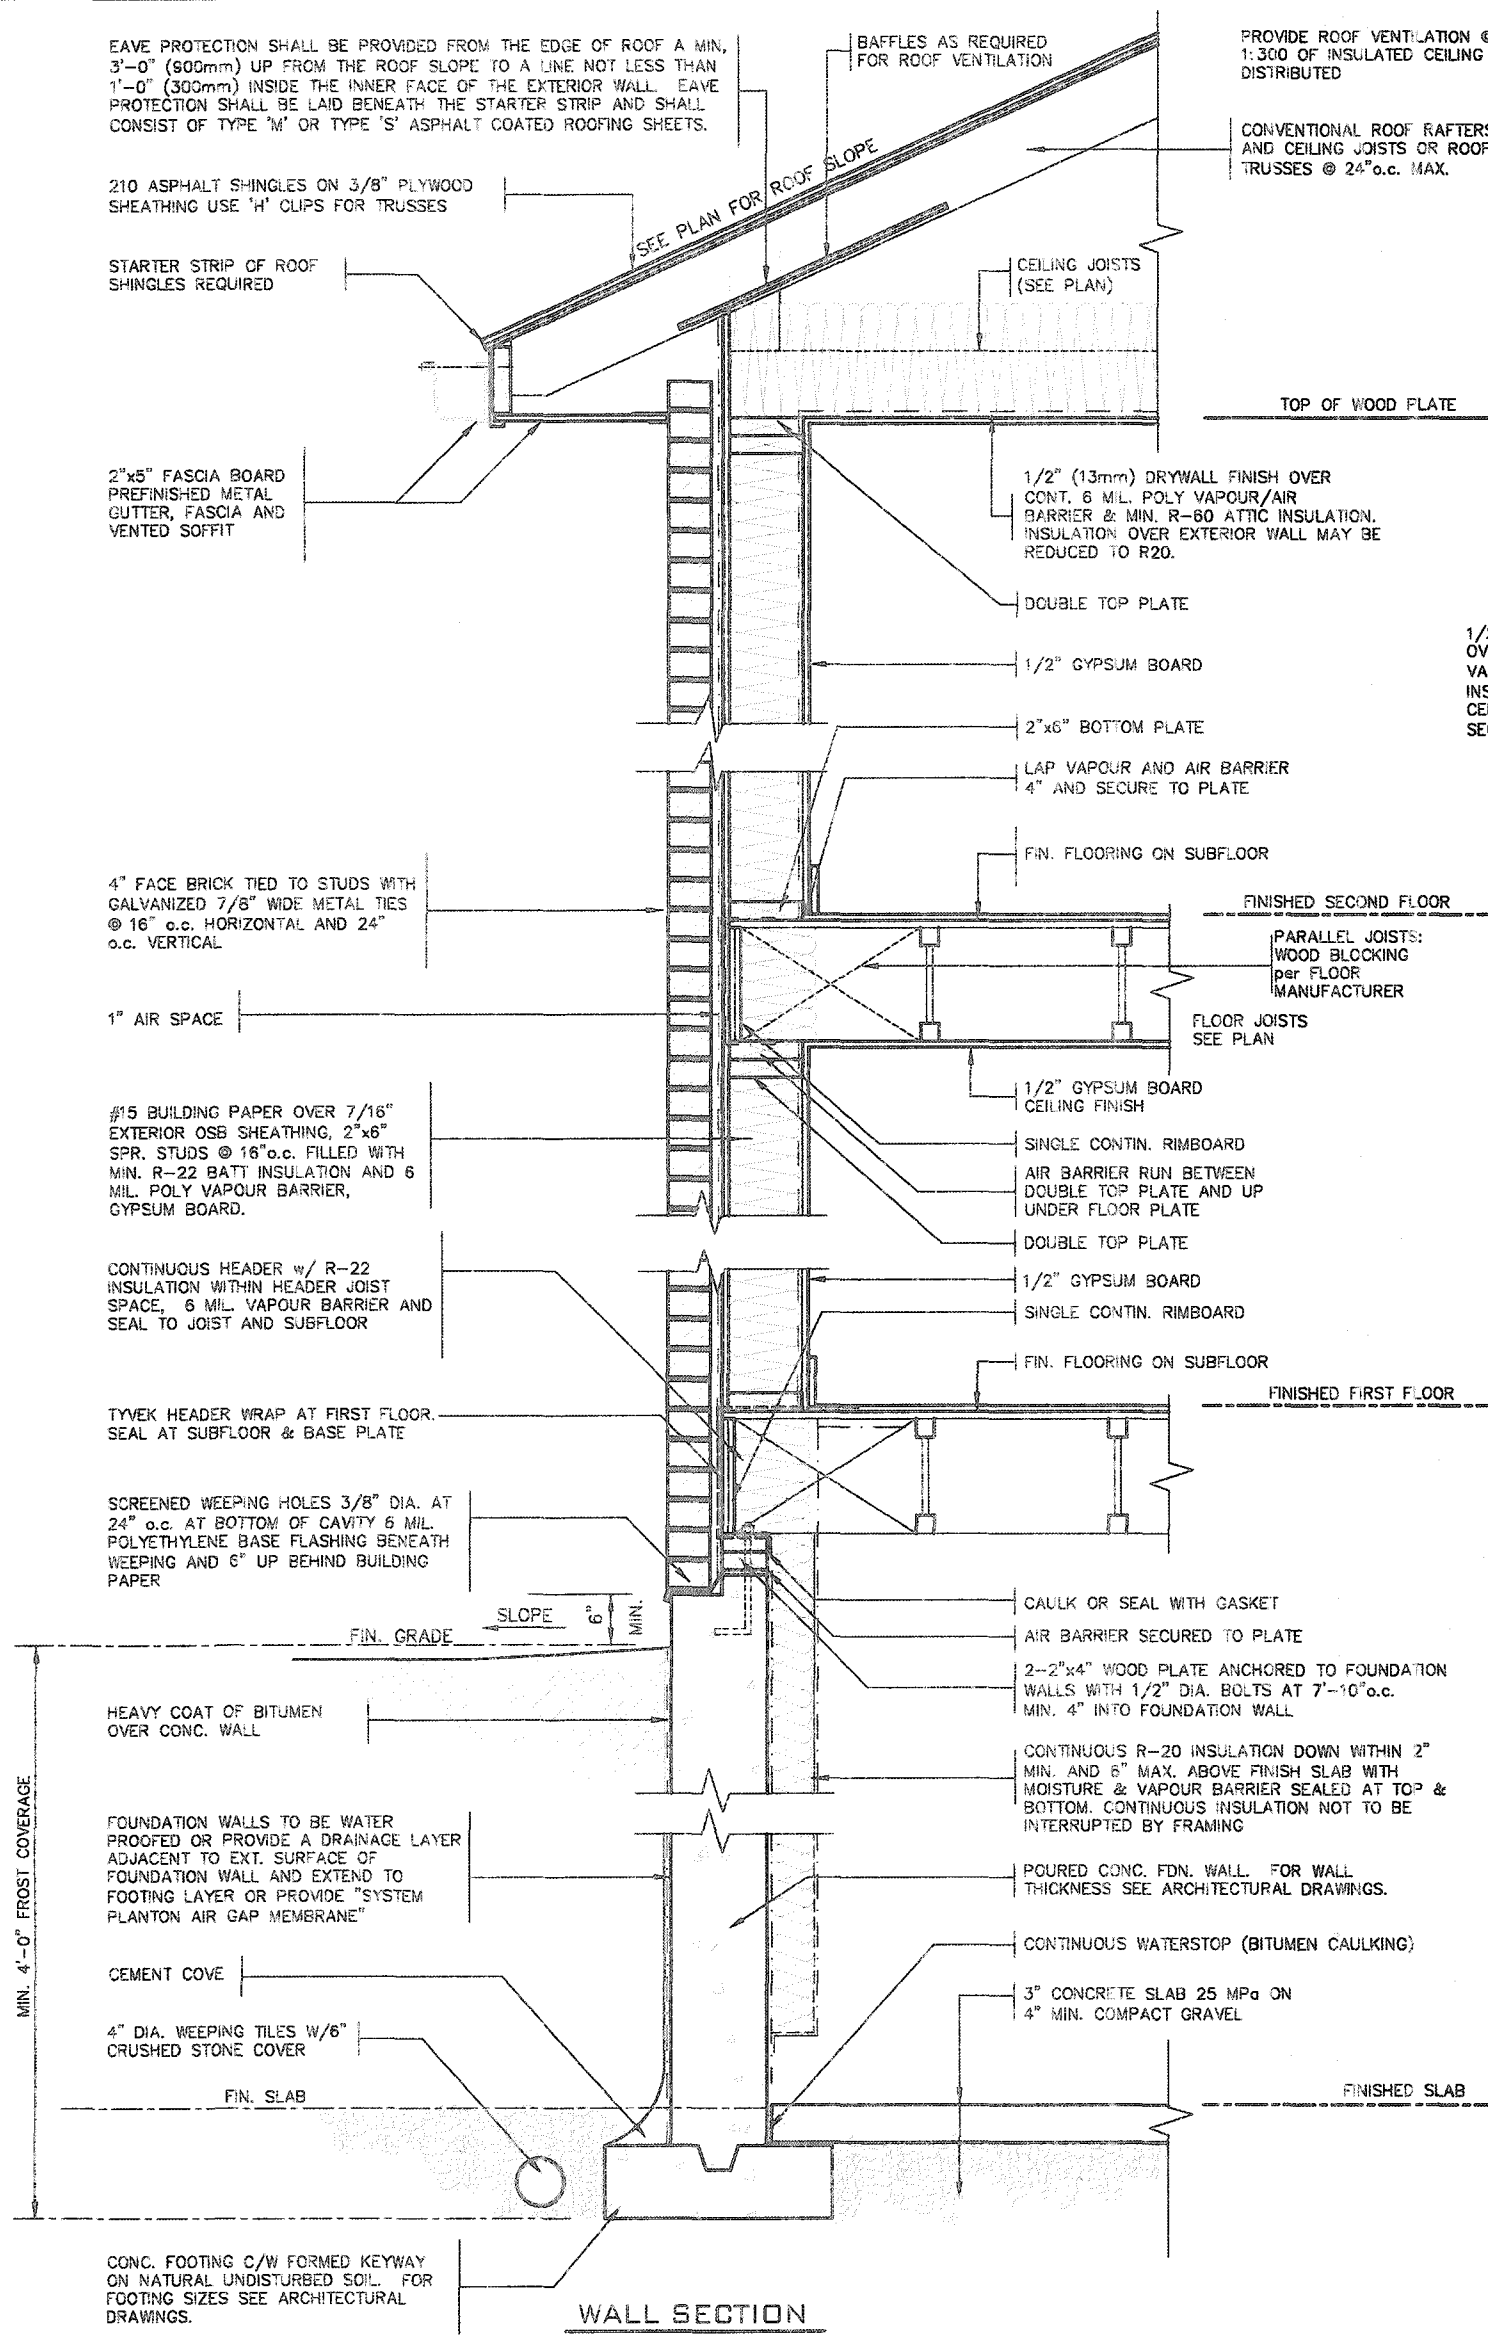

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department
FEB 05 2021
REC'D BY: _____ DATE: _____
REF'D TO: _____ DATE: _____

CITY OF HAMILTON
Building Division


Permit No. **21-102430**

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW


These drawings and/or specifications have been reviewed by
Kan Smith Feb. 24, 2021
FOR CHIEF BUILDING OFFICIAL DATE



1/2" (13mm) DRYWALL FINISH
OVER CONTINUOUS 6 MIL. POLY
VAPOUR/AIR BARRIER & MIN. R-31
INSULATION. (DRYWALL ON THE
CEILING ONLY WHEN THERE IS NO
SECOND FLOOR ABOVE GARAGE)

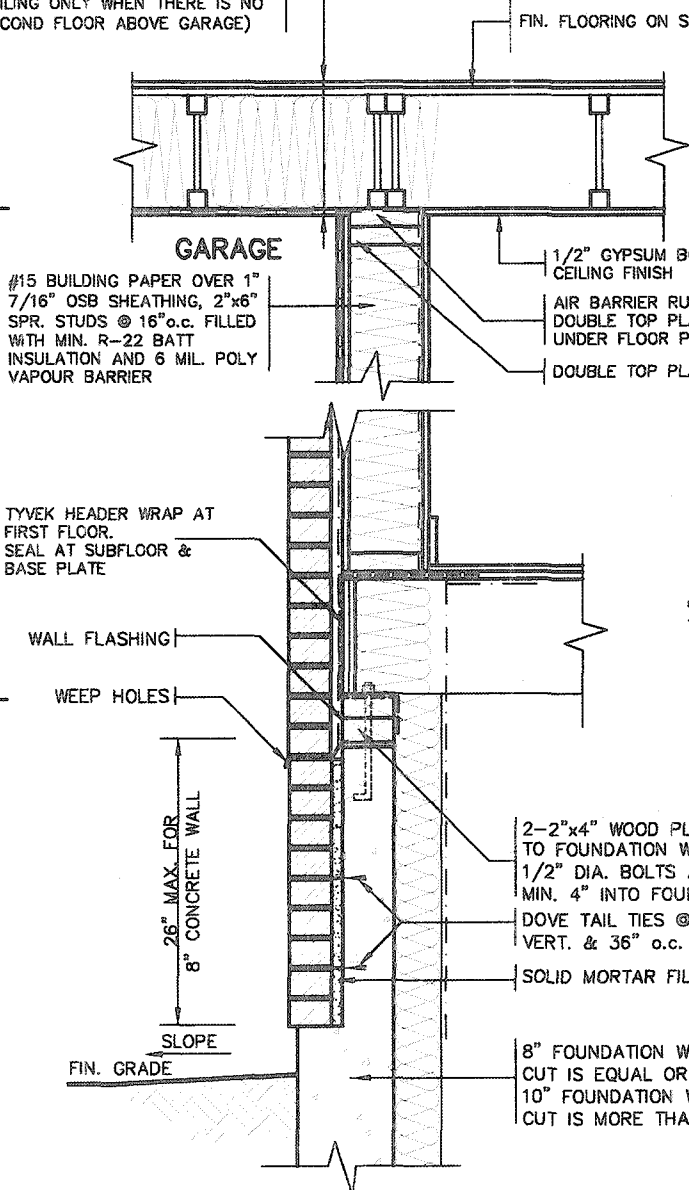

DETAIL FOR CONCRETE
VENEER DROPPED GRADE

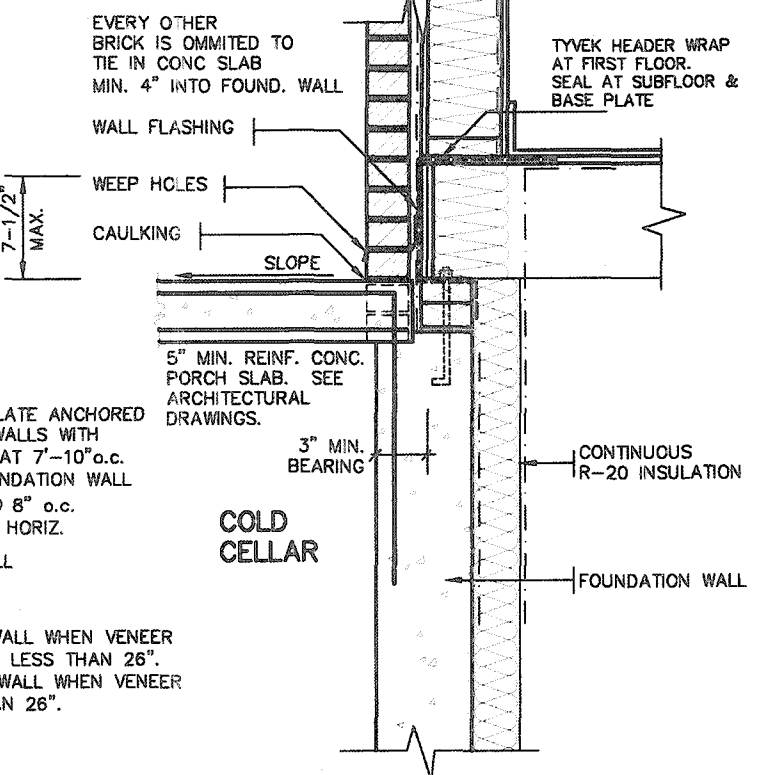


DETAIL FOR COLD CELLAR PORCH SLAB

2012 CODE COMPLIANCE PACKAGE A1

9 8 7 6 5 4 3 2 1 ISSUED FOR PERMIT date: APR 13/20 GW	The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. Richard Vink signature 24488 BCN VAS Design Inc. 42658 Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be used.	VAS DESIGN 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 vasdesign.com	Greenpark project name: RUSSELL GARDENS PH. 3 municipality: WATERDOWN project no.: 19014 date: APRIL 2020 checked by: 2" x 6" BRICK VENEER SECTIONS scale: Not to Scale drawing no.: 3 file name: 19014-GP-STD-DETAILS_A1
---	---	---	--

All drawings, specifications, related documents and design are the copyright property of VAS DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VAS DESIGN's written permission.

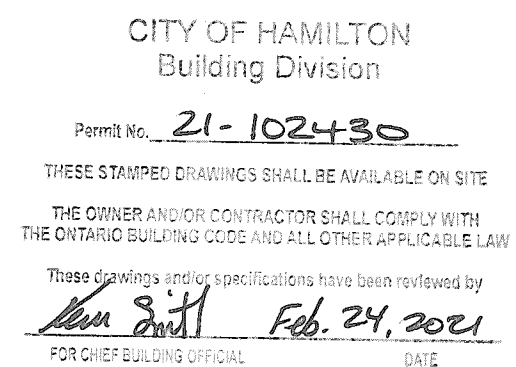

2012 CODE
COMPLIANCE PACKAGE A1

		The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.	
9			
8			
7		qualification Information	
6		Richard Vink	24488
5		name	BCN
4		registration information	
3		VAS Design Inc.	42658
2			
1			

Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings are specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be copied.

VAS DESIGN


255 Consumers Rd Suite 120
Toronto ON M2J 1R4
t 416.632.2255 f 416.630.4782
[vasdesign.com](#)

GreenparkSM

project name	municipality	project no.
RUSSELL GARDENS PH. 3	WATERDOWN	19014
date APRIL 2020		drawing no.
drawn by GW	checked by As Shown	fin name
		WOOD DECK PLANS
		19014-GP-STD_DETAILS_A1

5-1

All drawings, specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.

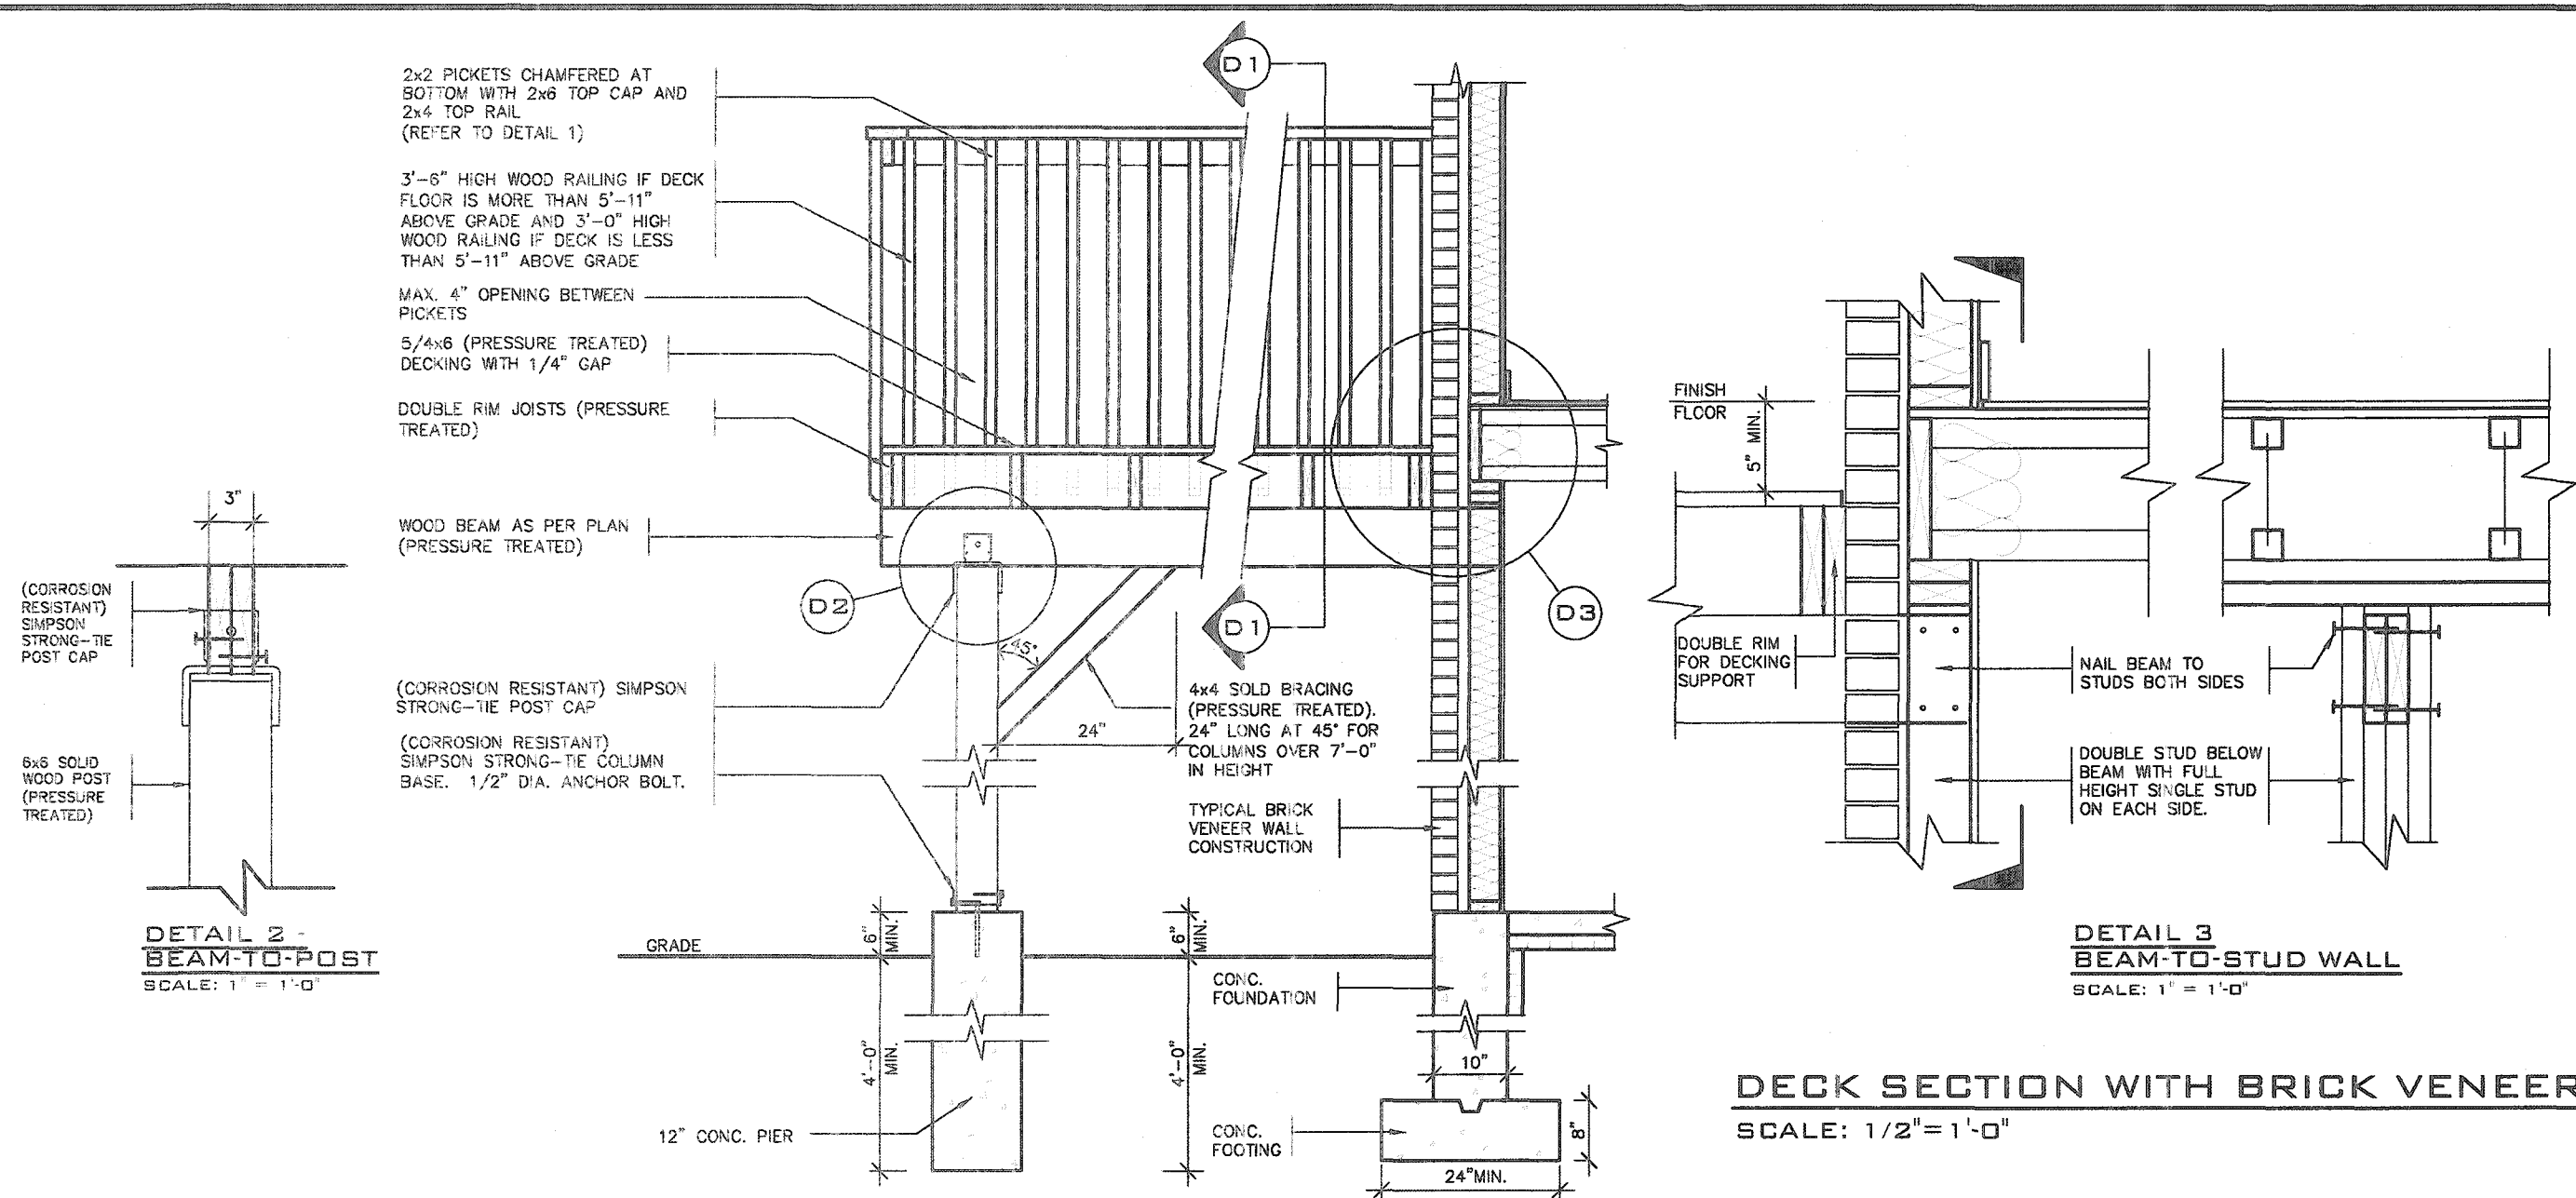

(CORROSION RESISTANT) SIMPSON STRONG-TIE POST CAP


6x6 SOLID WOOD POST (PRESSURE TREATED)

DETAIL 2 - BEAM-TO-POST
SCALE: 1" = 1'-0"


DETAIL 3 - BEAM-TO-STUD WALL
SCALE: 1" = 1'-0"

DECK SECTION WITH BRICK VENEER
SCALE: 1/2" = 1'-0"

DETAIL 1
CANTILEVERED PICKET SCREWED TO RIM JOIST AND DECK GUARD PARALLEL TO FLOOR JOISTS
SCALE: 1" = 1'-0"

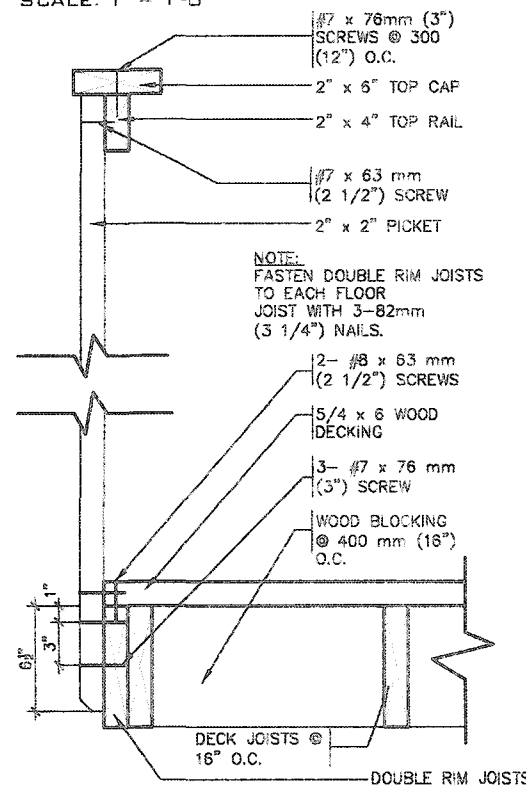

DETAIL 1
CANTILEVERED PICKET SCREWED TO RIM JOIST AND DECK GUARD PERPENDICULAR TO FLOOR JOISTS
SCALE: 1" = 1'-0"

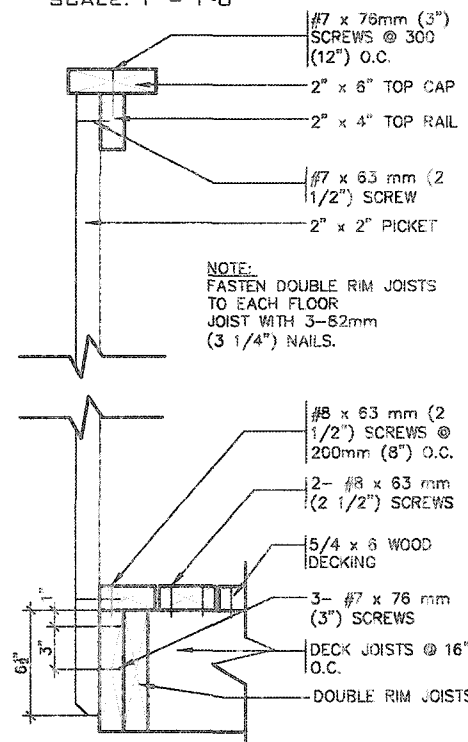

CITY OF HAMILTON
Building Division

Permit No. **21-102430**

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

Ken Smith Feb. 24, 2021

FOR CHIEF BUILDING OFFICIAL DATE

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department

FEB 05 2021

REC'D BY _____ DATE _____

REF'D TO _____ DATE _____

GENERAL NOTES

- BRICK TO HAVE COMPRESSIVE STRENGTH OG 15MPa (2200 p.s.i) MIN. UNITS TO BE LAID WITH FULL HEAD AND BED JOINTS.
- MORTAR TO BE TYPE 'S' WITH JOINT THICKNESS OF 10mm (3/8") MIN. AND 20mm (3/4") MAX.
- THE DECK HAS BEEN DESIGNED TO SAFELY SUPPORT A SUPERIMPOSED LOAD OF 1.9kPa. [40psf].
- ALL NAILS AND SCREWS TO BE GALVANIZED.
- WOOD FOR CANTILEVERED PICKETS SHALL BE DOUGLAS FIR-LARCH, SPRUCE-PINE-FIR, OR HEM-FIR SPECIES.
- CONCRETE SHALL HAVE COMPRESSIVE STRENGTH OF 20MPa. AT 28 DAYS AND 5-8% AIR ENTRAINED.
- FOOTING TO BE PLACED ON UNDISTURBED SOIL WITH MINIMUM BEARING PRESSURE OF 150kPa [3130psf].
- WB1= 2- 2"x8" (PRESSURE TREATED)
WB3= 2- 2"x10" (PRESSURE TREATED)

STRUDET INC.



FOR STRUCTURE ONLY

2012 CODE COMPLIANCE PACKAGE A1

9					
8					
7					
6					
5					
4					
3					
2					
1	ISSUED FOR PERMIT	APR 13/20	GW		
no.	description	date	by		

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.

Richard Vink 24488 BCN

name registration information 42658

VA3 Design Inc.

Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be sold.

VA3 DESIGN

255 Consumers Rd Suite 120
Toronto ON M2J 1R4
t 416.630.2255 f 416.630.4782
va3design.com

Greenpark.

project name **RUSSELL GARDENS PH. 3** municipality **WATERDOWN**



date **APRIL 2020** title **WOOD DECK DETAILS-WALK-OUT CONDITION**

drawn by **GW** checked by **As Shown** scale **As Shown** file name **19014-GP-STD_DETAILS_A1**

SINGLES

project no. **19014**

drawing no. **6**



STRUDET INC.

REGISTERED PROFESSIONAL ENGINEER

B. MARINKOVIC

APRIL 15 2020

PROVINCE OF ONTARIO

FOR STRUCTURE ONLY

2012 CODE COMPLIANCE PACKAGE

9						The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.
8						
7						qualification information
6						Richard Vink 2448
5						name BC
4						registration information
3						VAS Design Inc. 4265
2						
1	ISSUED FOR PERMIT.	APR 13/20	GW			Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be copied.
	no. description	date	by			


VA3
DESIGN
255 Consumers Rd Suite
Toronto ON M2J 1R4
t 416.630.2255 f 416.630
va3design.com

 Greenpark.		SINGLES -	
project name RUSSELL GARDENS PH. 3		municipality WATERDOWN	
project no. 19014		drawing no. 8	
date APRIL 2020		STUD WALL REINFORCEMENT	
drawn by GW	checked by -	scale Not to Scale	file name 19014-GP-STD_DETAILS_A1


All drawings, specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department
FEB 05 2021
REC'D BY _____ DATE _____
REF'D TO _____ DATE _____

CITY OF HAMILTON
Building Division
Permit No. 21-102430
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
Ken Smith Feb. 24, 2021
FOR CHIEF BUILDING OFFICIAL DATE

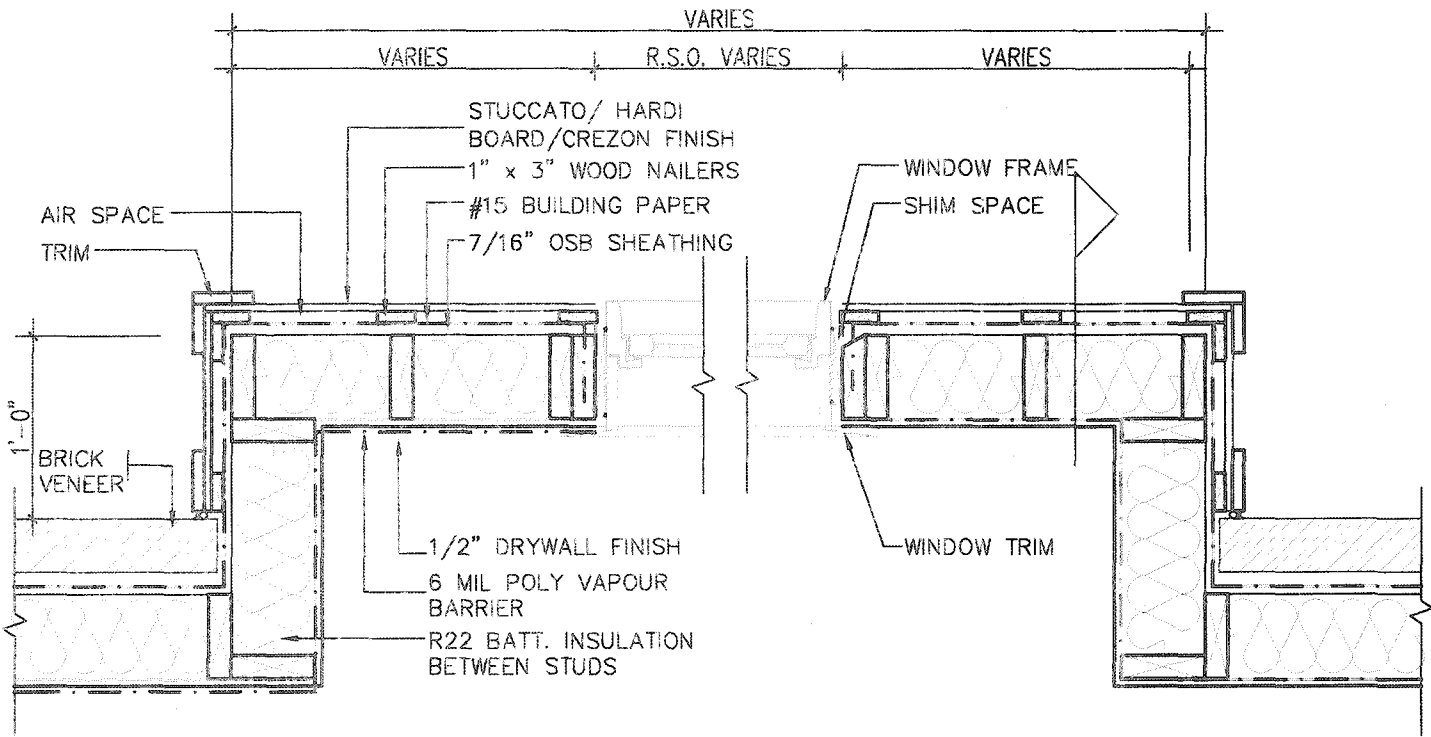

PLAN VIEW

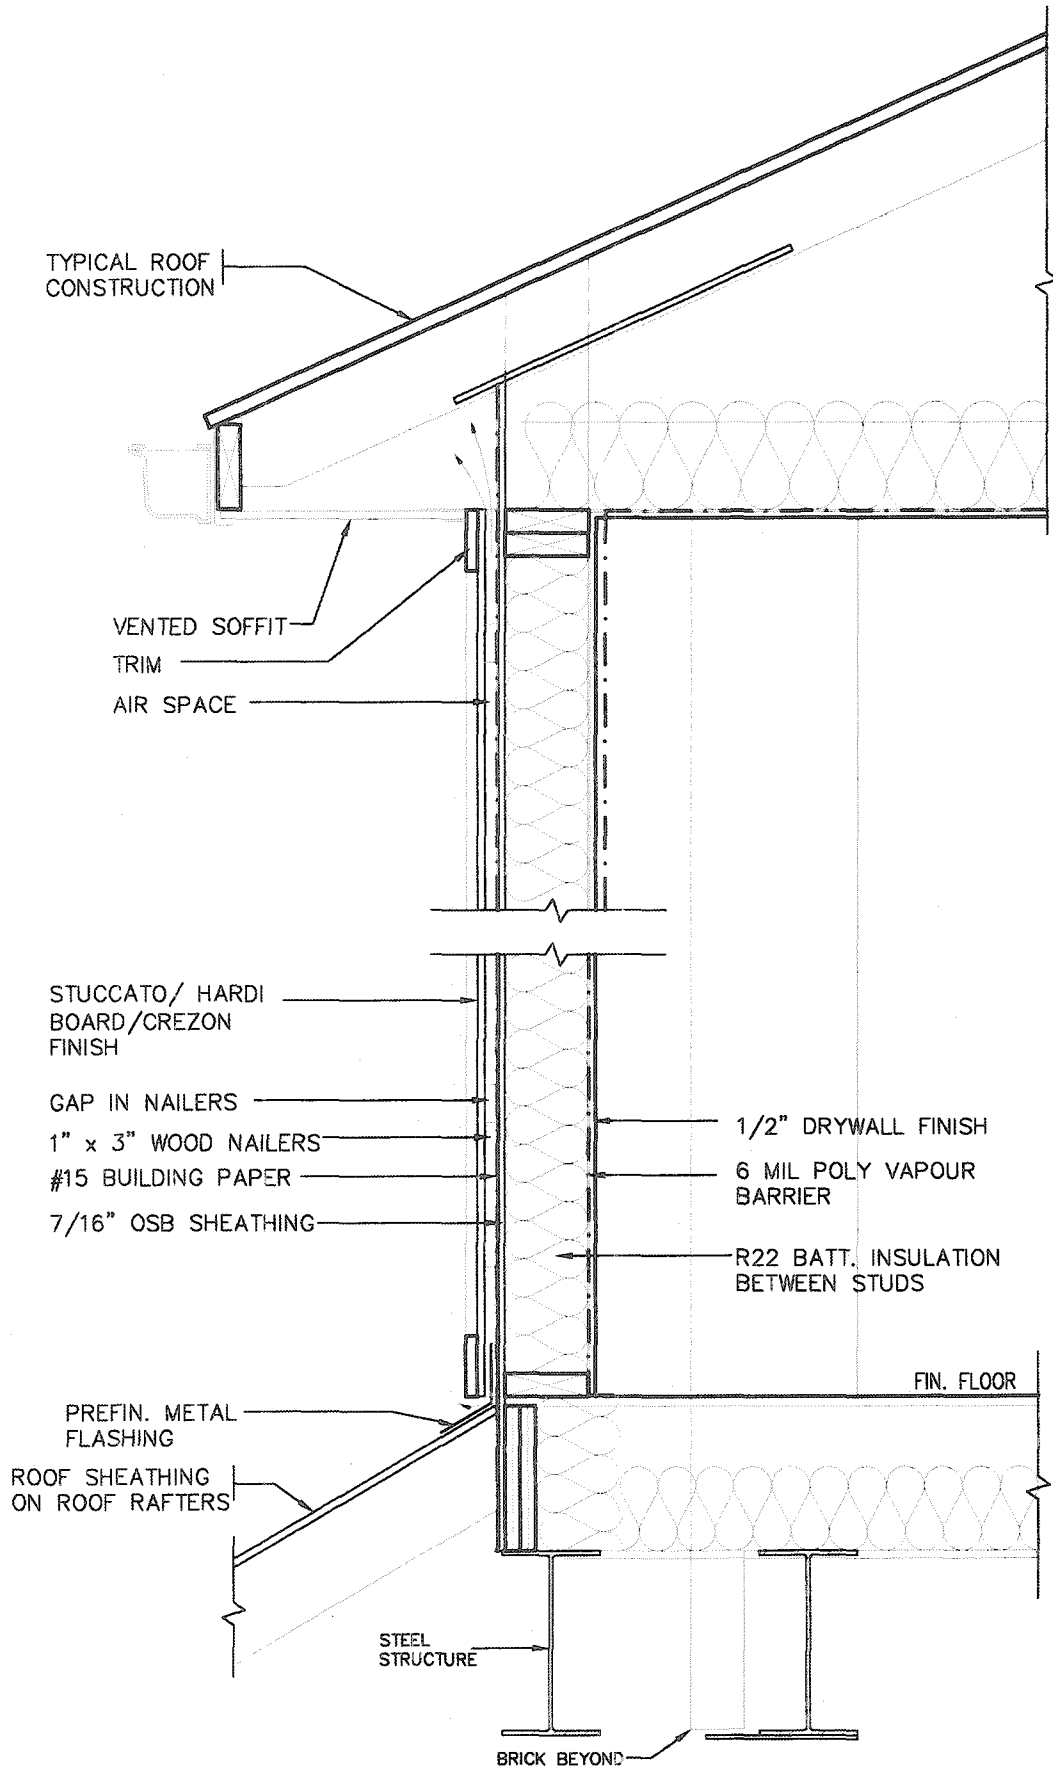


CROSS SECTION

STUCCATO BOARD FINISH CLADDING OR EQUAL (OBC 9.27.)




2012 CODE
COMPLIANCE PACKAGE A1


9. _____		The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.		VA3 DESIGN		Greenpark.		SINGLES	
8. _____		qualification information		24488		project name		project no.	
7. _____		Richard Vink		BCN		RUSSELL GARDENS PH. 3		19014	
6. _____		signature		42658		municipality		drawing no.	
5. _____		VA3 Design Inc.		255 Consumers Rd Suite 120		STUCCATO/ HARDI BOARD FINISH		9	
4. _____		Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be copied.		Toronto ON M2J 1R4		date		file name	
3. _____		1 ISSUED FOR PERMIT.		APR 13/20 GW		APRIL 2020		19014-GP-STD_DETAILS_A1	
2. _____		no. description		date by		checked by		scale	
1. _____						Not to Scale			

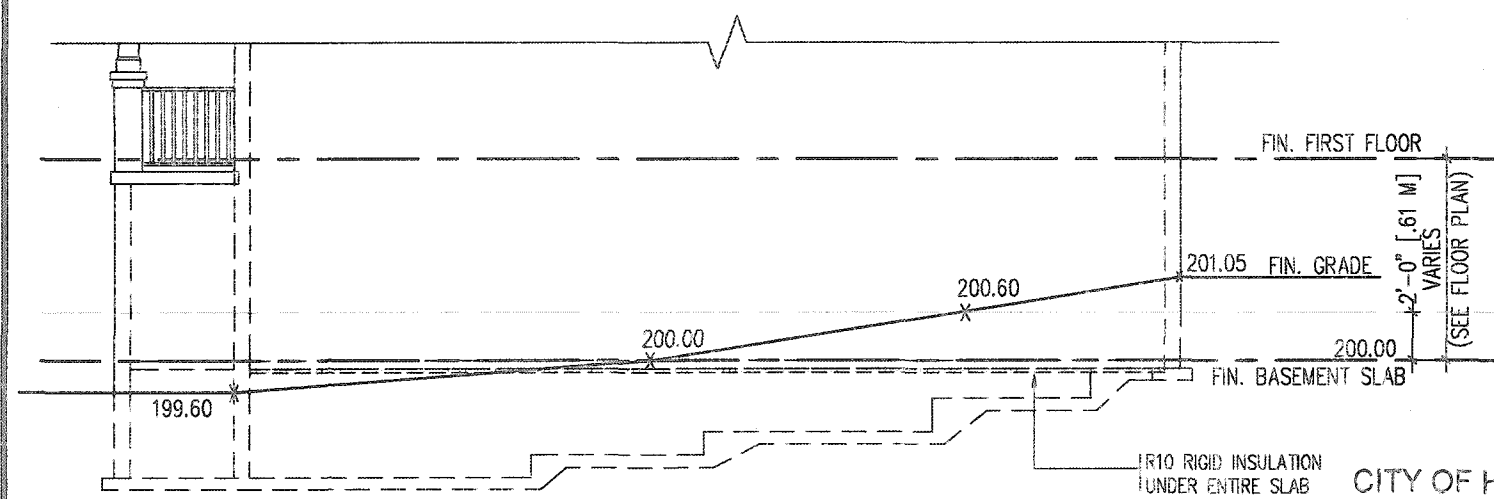

TYPICAL RIGHT SIDE ELEVATION

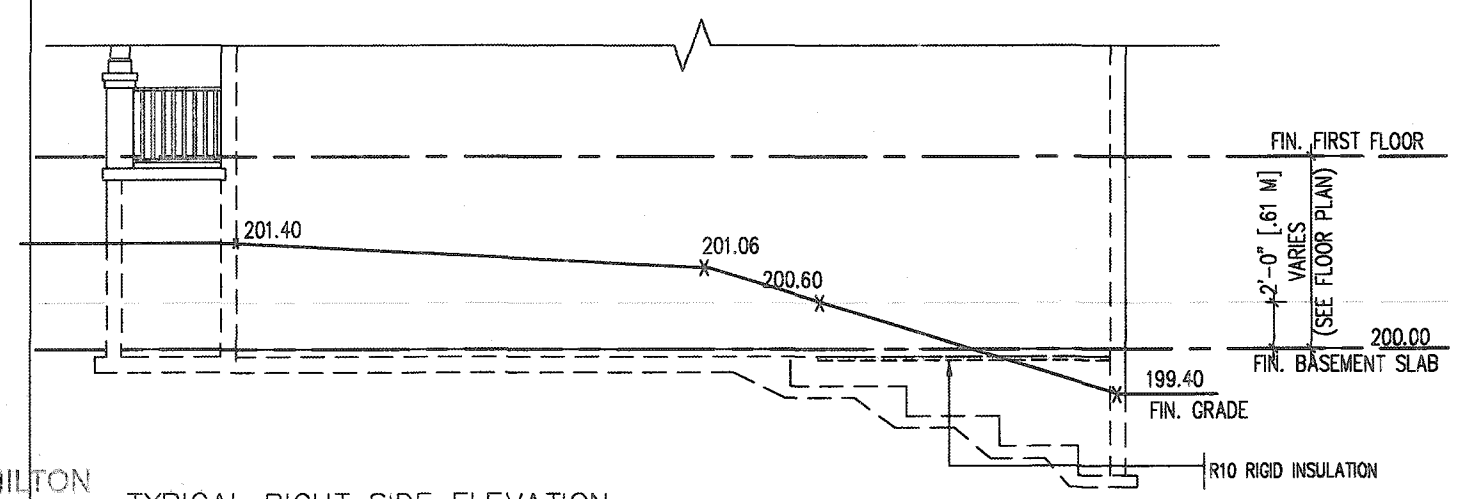


TYPICAL RIGHT SIDE ELEVATION

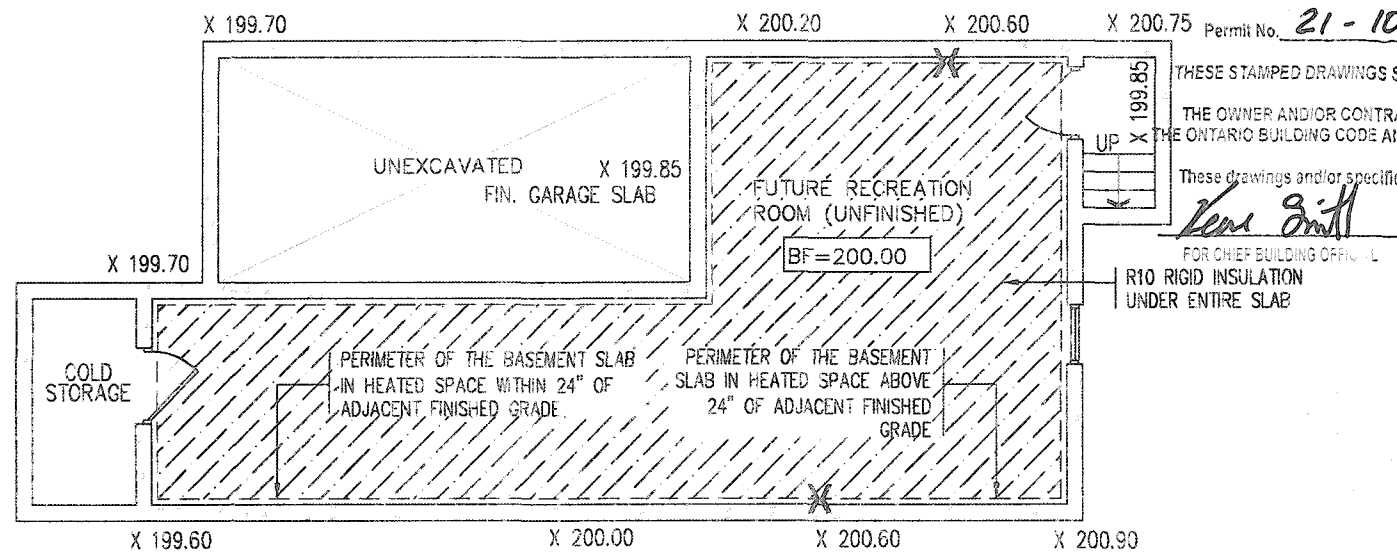

TYPICAL BASEMENT PLAN

SLAB ON GRADE CONDITION

- NOTES:
1. LEVELS SHOWN ON THE PLANS ARE FOR ILLUSTRATION PURPOSE ONLY, SEE FINAL GRADING PLAN FOR ACTUAL LEVELS
 2. ALL LEVELS ARE SHOWN IN METRIC

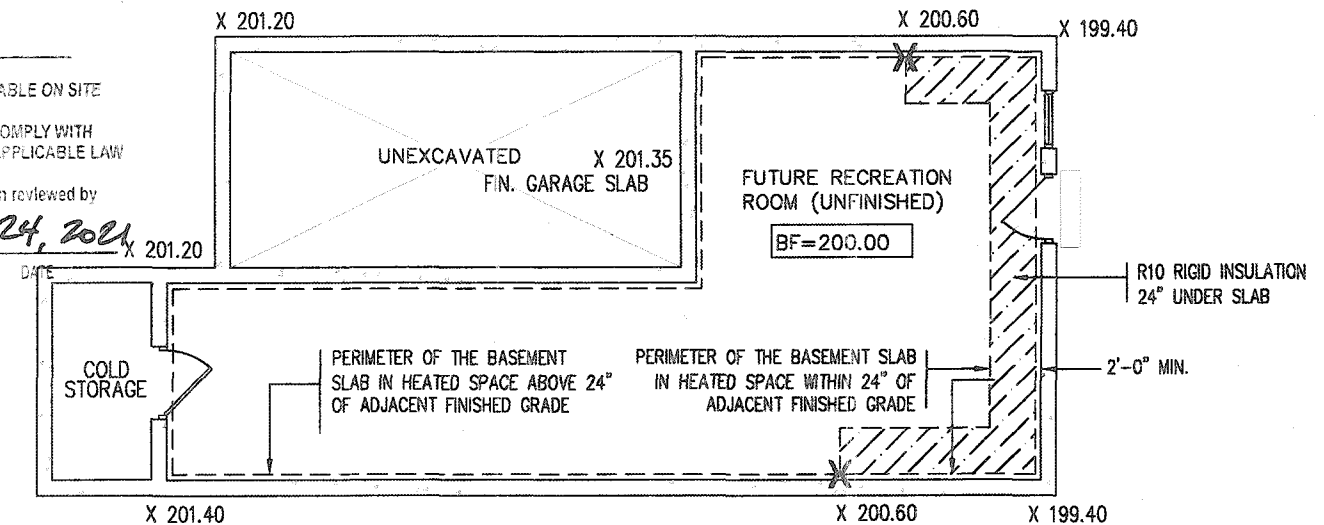

TYPICAL BASEMENT PLAN


WALK OUT BASEMENT CONDITION

- NOTES:
1. LEVELS SHOWN ON THE PLANS ARE FOR ILLUSTRATION PURPOSE ONLY, SEE FINAL GRADING PLAN FOR ACTUAL LEVELS
 2. ALL LEVELS ARE SHOWN IN METRIC


CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department

FEB 05 2021

REC'D BY _____ DATE _____
REF'D TO _____ DATE _____

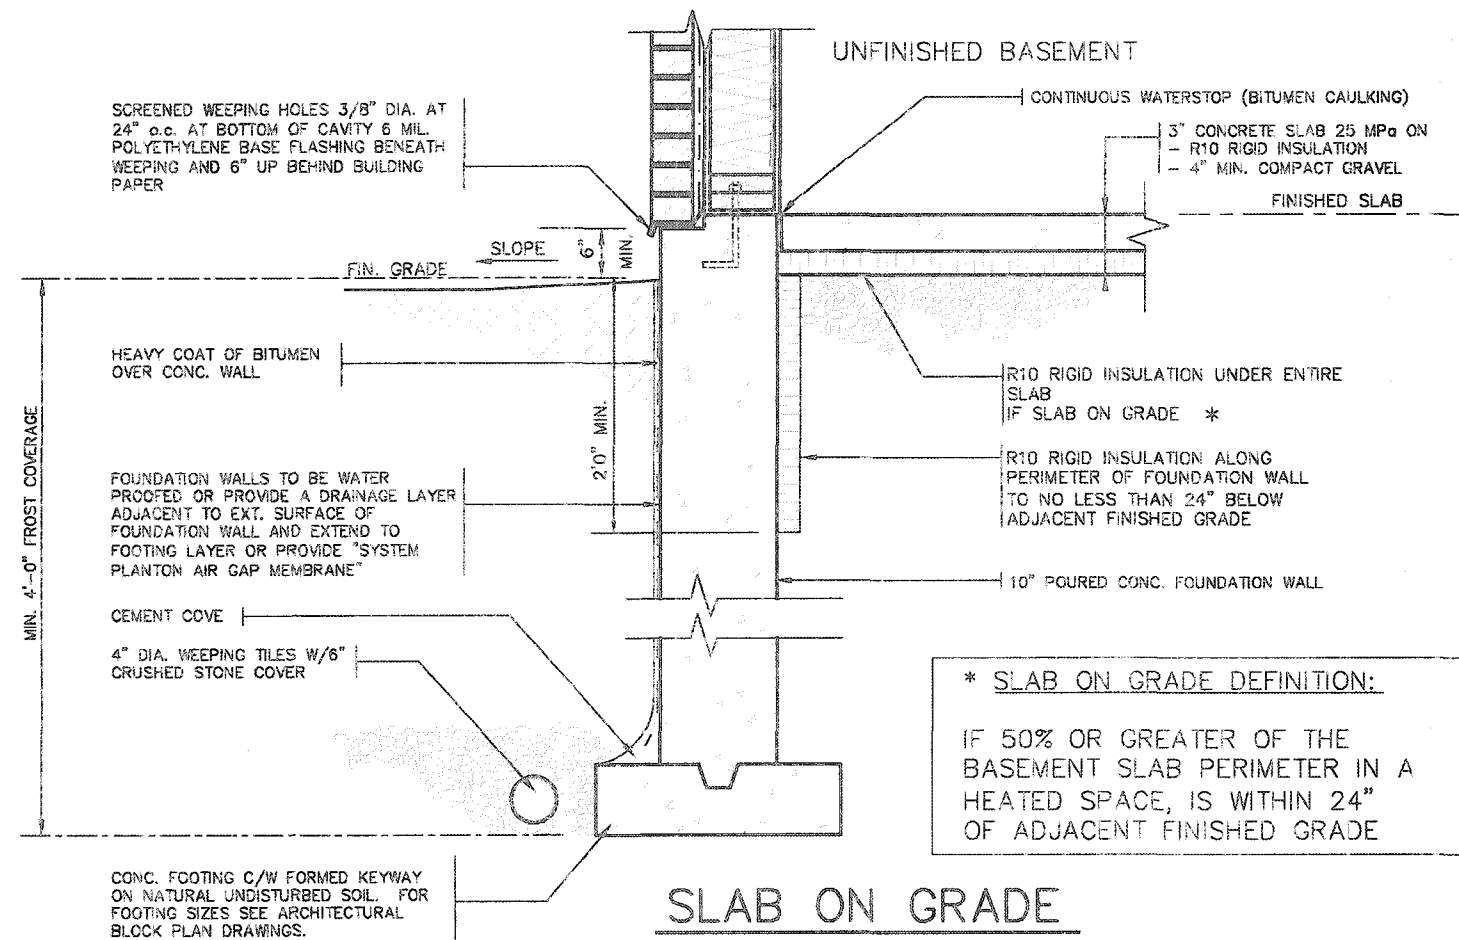


SLAB ON GRADE

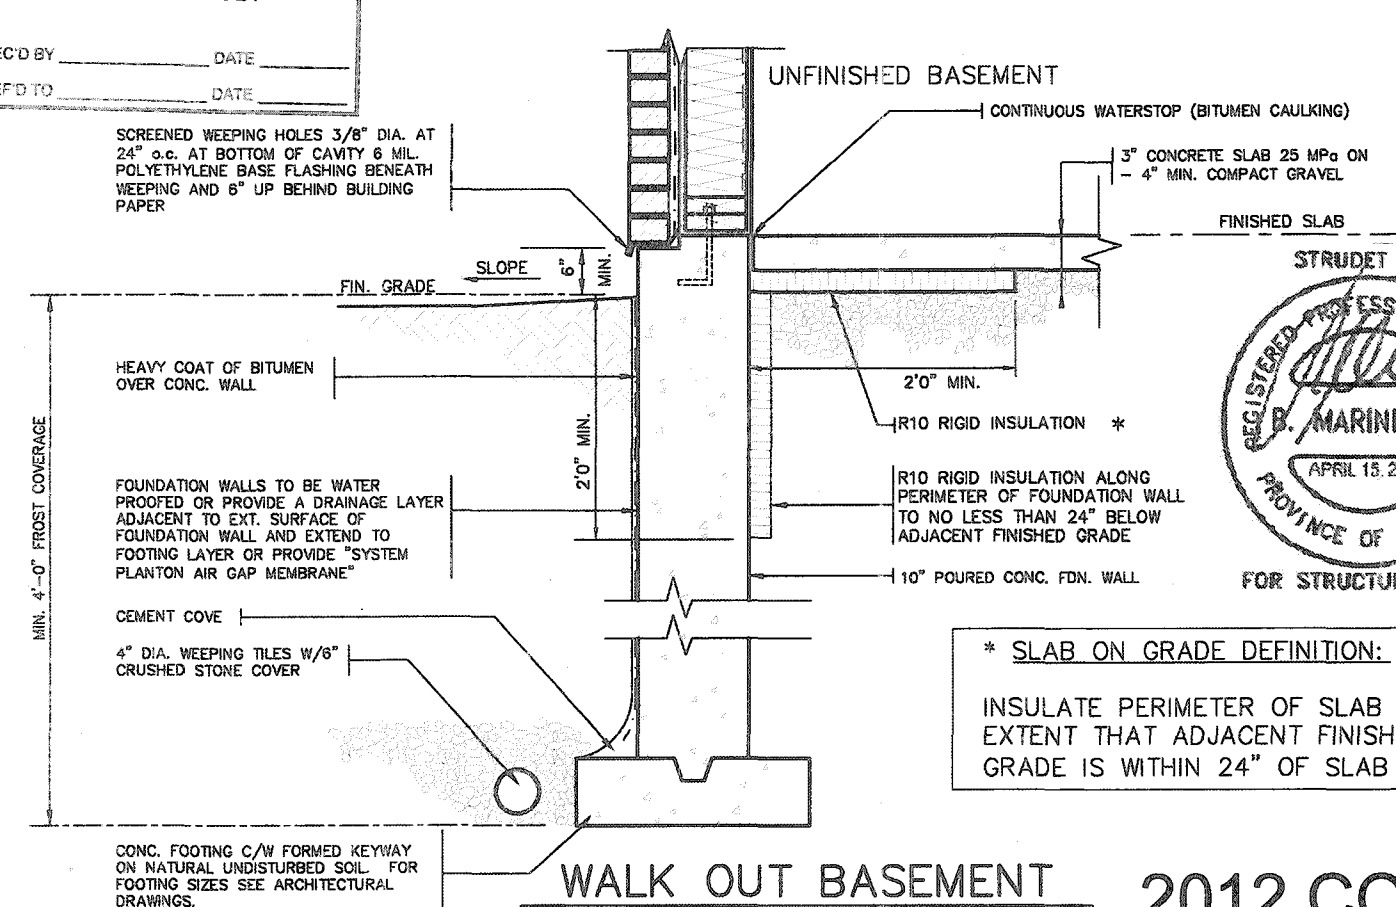

WALK OUT BASEMENT

2012 CODE COMPLIANCE PACKAGE

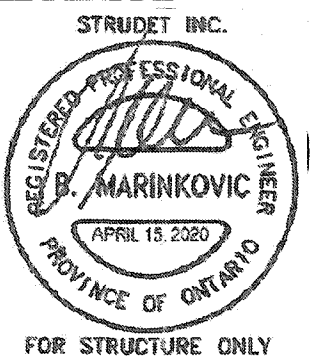

9					
8					
7					
6					
5					
4					
3					
2					
1	ISSUED FOR PERMIT.	APR 13/20	GW		
no.	description	date	by		

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.

qualification information
Richard Vink 24488 BCN
name
VA3 Design Inc. 42658
registration information

Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.

VA3 DESIGN
255 Consumers Rd Suite 120
Toronto ON M2J 1R4
t 416.630.2255 f 416.630.4782
va3design.com


project name RUSSELL GARDENS PH. 3	municipality WATERLOON	project no. 19014
date APRIL 2020	checked by SLAB ON GRADE INSULATION	drawing no. 10
drawn by GW	scale Not to Scale	file name 19014-GP-STD_DETAILS_A1



NOTE: FOR MORE THAN 8 RISERS

GENERAL NOTES

1. EXTERIOR STAIRS
7 7/8" RISE MAXIMUM
8 1/4" RUN MINIMUM
9 1/4" TREAD MINIMUM
2. MASONRY TIES
WHEN BRICK FACING IS USED ABOVE GRADE LEVEL, PROVIDE 3/16" DIA. CORROSION RESISTANT METAL TIES @ 36" HORIZONTAL & 8" VERTICAL
3. GUARDS
ARE REQUIRED AROUND CONCRETE SLAB IF MORE THAN 2'-0" ABOVE GRADE & ON BOTH SIDES OF STAIRS CONTAINING MORE THAN 6 RISERS. MINIMUM 34" HIGH FOR STAIRS MINIMUM 36" HIGH FOR PORCHES UP TO 5'-11" ABOVE GRADE. MINIMUM 42" HIGH FOR GREATER HTS.
4. HANDRAIL
ARE REQUIRED WHERE STEPS HAVE MORE THAN 3 RISERS . HANDRAIL HEIGHT 34" - 38".
5. FOUNDATION WALLS
THICKNESS OF FOUNDATION WALLS IS DEPENDANT UPON VENEER CUT 8" FOR UP TO 26" VENEER CUT HEIGHT 10" FOR VENEER CUT OVER 26" HIGH
6. CONCRETE
MINIMUM CONCRETE STRENGTH SHALL BE 4650 PSI [32MPa] W/ 5%-8% AIR ENTRAINMENT MINIMUM CONCRETE SLAB THICKNESS 5"
7. CONCRETE COVER
PROVIDE MINIMUM 3/4" CLEAR CONCRETE COVER TO REINFORCING BARS

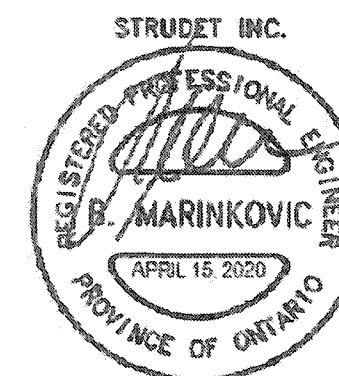

FOR STRUCTURE ONLY

CITY OF HAMILTON
Building Division

Permit No. 21-102430

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

FOR CHIEF BUILDING OFFICIAL

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.

qualification information	<i>R Vink</i>	2448
Richard Vink	signature	BC
name		
registration information		
VAS Design Inc.		4265

Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be copied.

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department

FEB 05 2021

REC'D BY _____ DATE _____
REF'D TO _____ DATE _____

REF'D TO _____ DATE _____

**2012 CODE
COMPLIANCE PACKAGE A1**

SINGLES

Greenpark

project name	municipality
RUSSELL GARDENS PH. 3	WATERDOWN

date **APRIL 2020** **POURED CONC. PORCH STEPS**


32 GW - Not to Scale 19014-GP-STD_DETAILS_A

project no.
19014


drawing no. 11

1

All drawings, specifications, related documents and design are the copyright property of V43 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without V43 DESIGN's written permission.

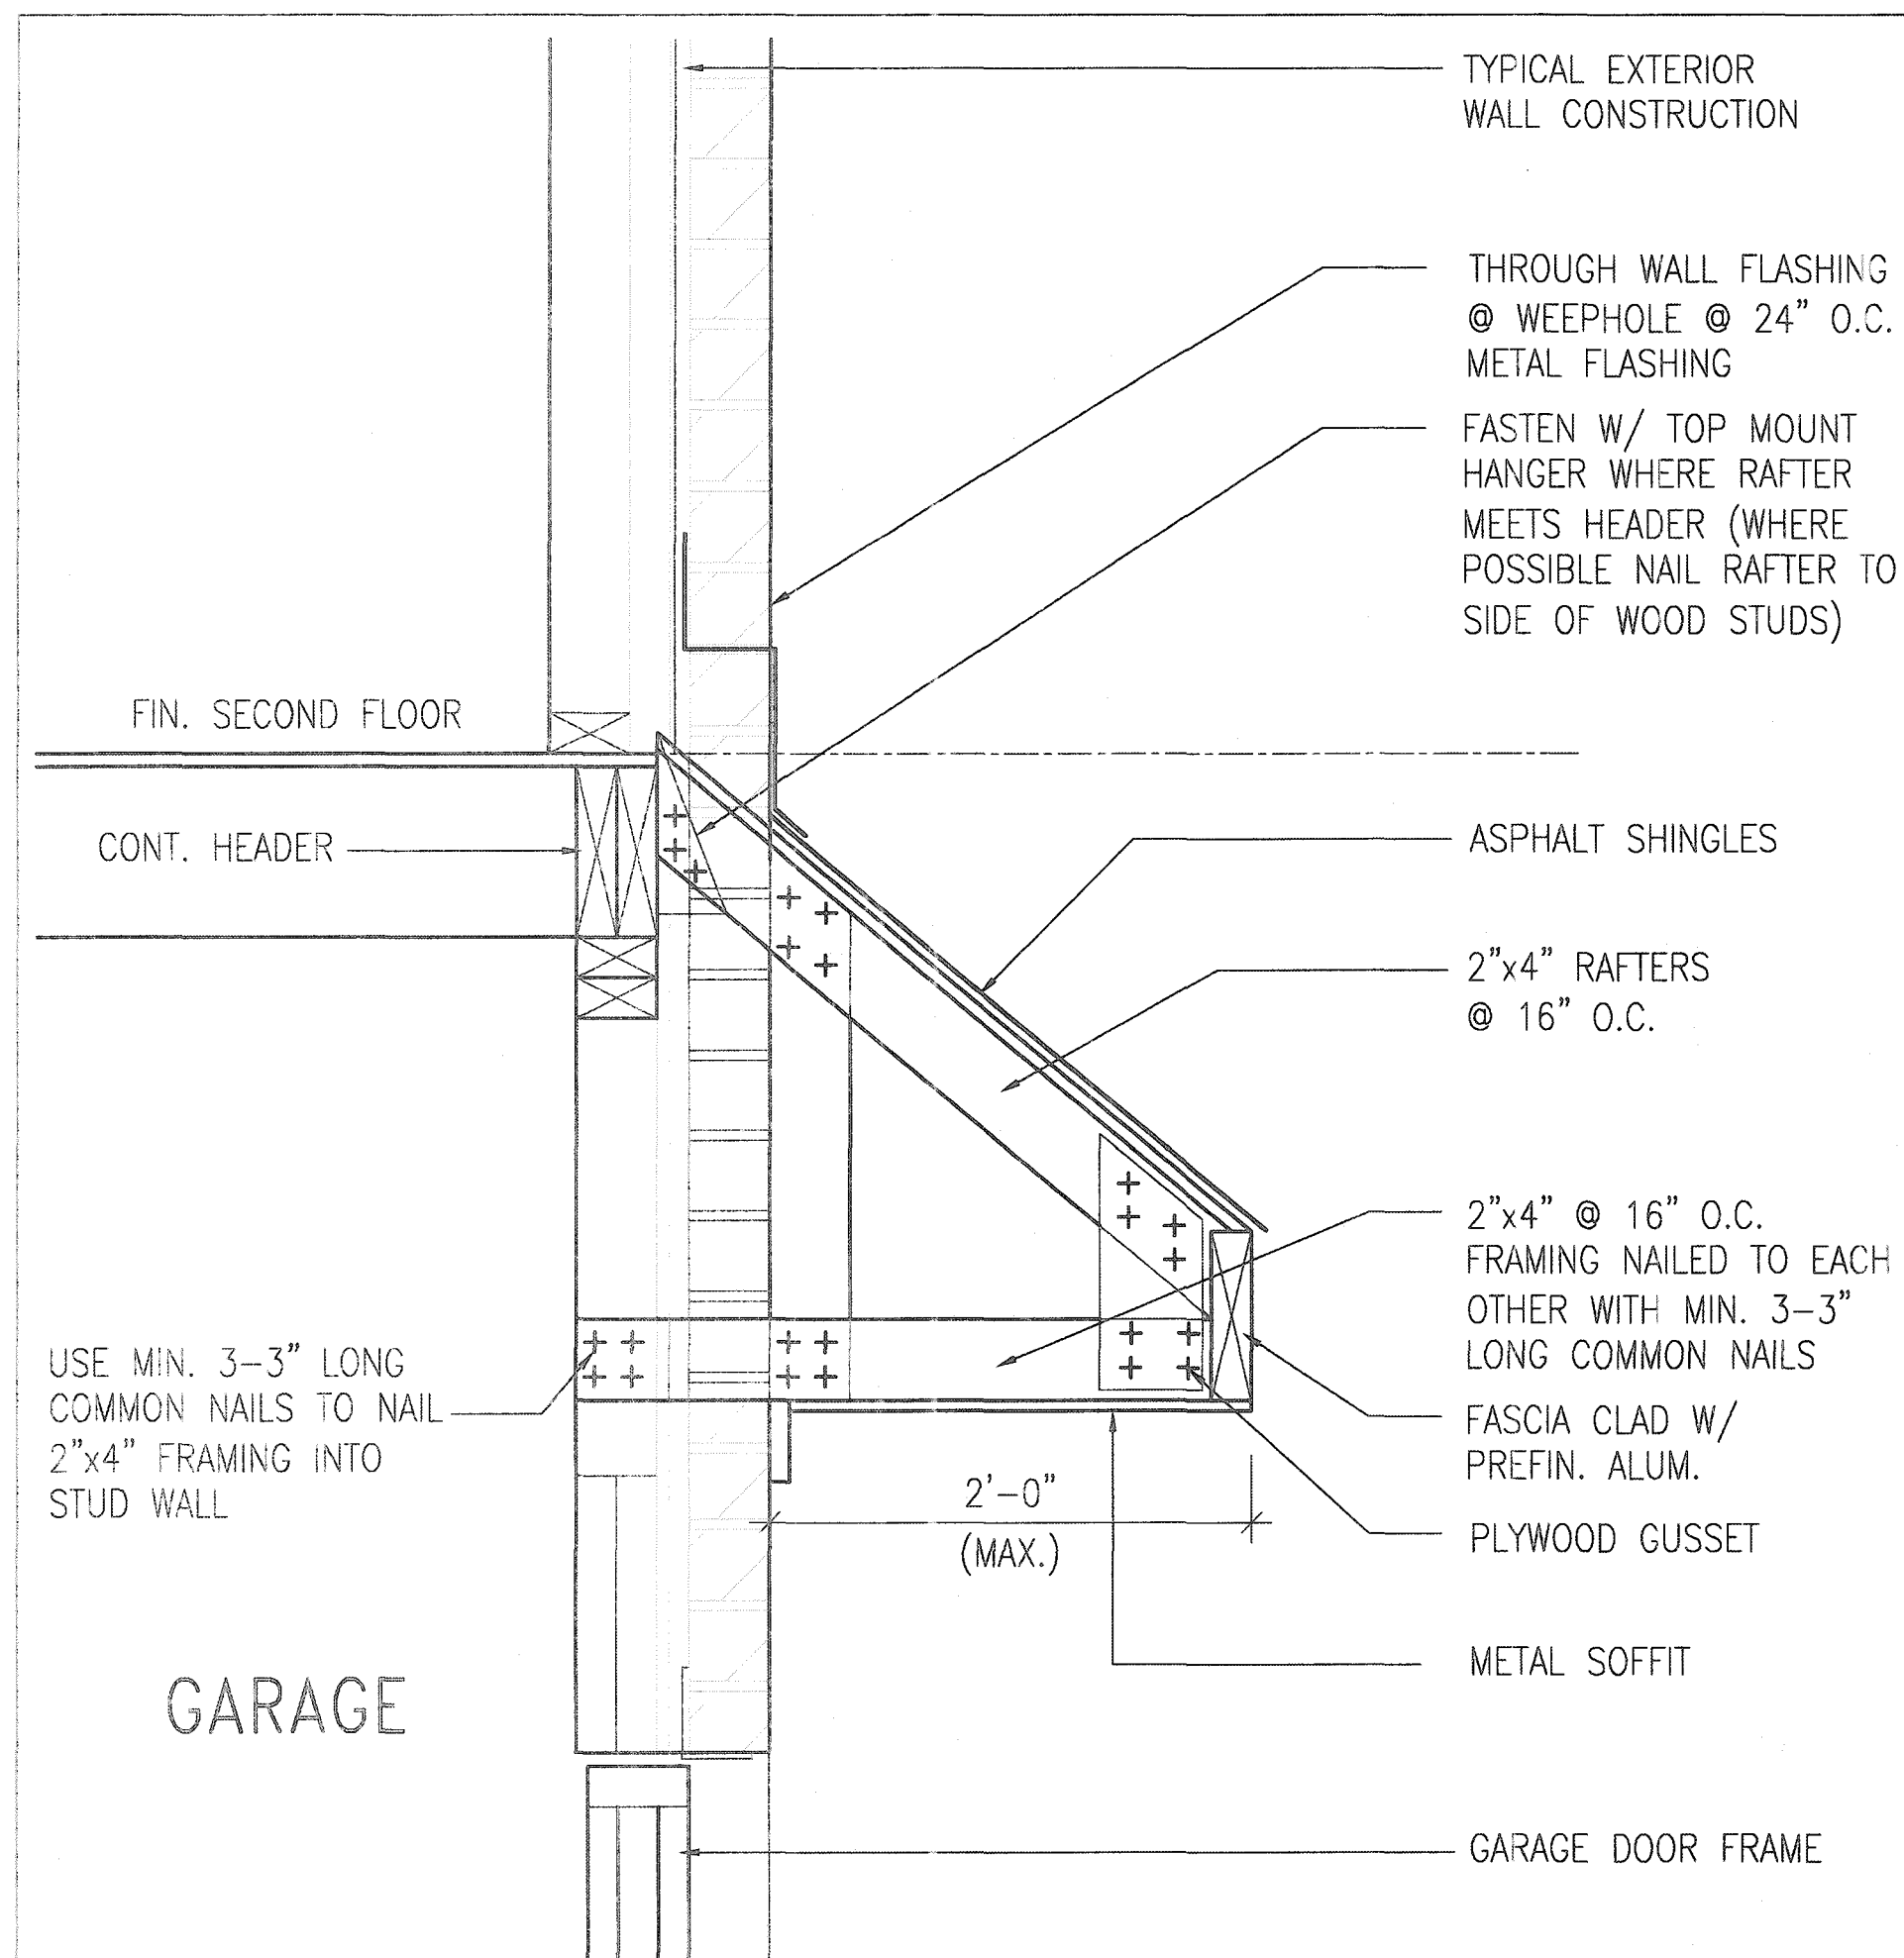

B ROOF OVERHANG DETAIL OVER GARAGE

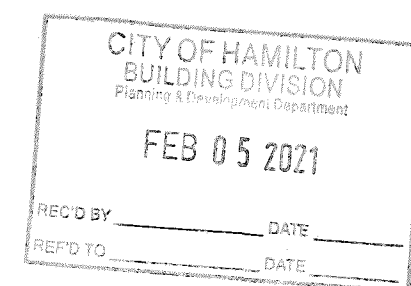


CITY OF HAMILTON
Building Division

Permit No. 21-102430

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by
Ken Smith Feb. 24, 2021
FOR CHIEF BUILDING OFFICIAL DATE

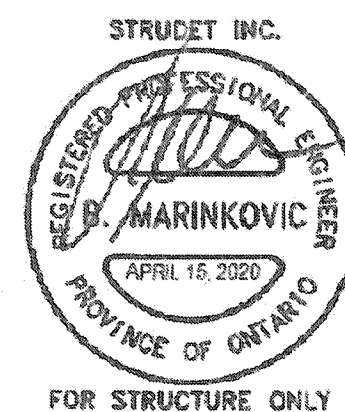

2012 CODE
COMPLIANCE PACKAGE A1

9. _____ 8. _____ 7. _____ 6. _____ 5. _____ 4. _____ 3. _____ 2. _____ 1. ISSUED FOR PERMIT.		The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. qualification information Richard Vink 24488 name registration information VAS Design Inc. 42658 date by APR 13/20 GW	VA3 DESIGN 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 va3design.com	Greenpark. project name RUSSELL GARDENS PH. 3 date APRIL 2020 drawn by GW	municipality WATERDOWN checked by - scale Not to Scale	project no. 19014 drawing no. 12
no. description		DETAIL OF EXTENDED ROOF 19014-GP-STD_DETAILS_A1				

SUPPORTED STEEL
ANGLE UP TO
11'-7". OTHERWISE
TO BE REVIEWED BY
ENGINEER.

BRICK/
STONE
VENEER

INVERTED
3-1/2"x3-1/2"x1/4"
(90x90x6.0)
STEEL ANGLE

INVERTED
3-1/2"x3-1/2"x1/4"
(90x90x6.0)
STEEL ANGLE


BRICK/
STONE
VENEER

SUPPORTED STEEL
ANGLE UP TO 11'-7".
OTHERWISE TO BE
REVIEWED BY ENGINEER.

INVERTED STEEL
ANGLE DETAIL


CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department
FEB 05 2021
REC'D BY: _____ DATE: _____
REF'D TO: _____ DATE: _____

CITY OF HAMILTON
Building Division
Permit No. 21-102430
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
Ken Smith Feb. 24, 2021
FOR CHIEF BUILDING OFFICIAL DATE

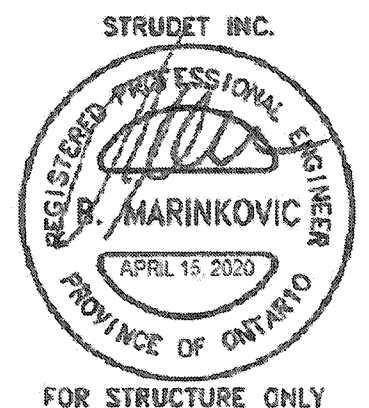


2012 CODE
COMPLIANCE PACKAGE A1

9 8 7 6 5 4 3 2 1 ISSUED FOR PERMIT.		APR 13/20 GW		The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. qualification information Richard Vink 24488 name registration information VAS Design Inc. 42658 Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be copied.		VA3 DESIGN 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 va3design.com		Greenpark. project name RUSSELL GARDENS PH. 3 municipality WATERLOON date APRIL 2020 drawn by GW checked by - scale Not to Scale project no. 19014 drawing no. 13		SINGLES project no. 19014 drawing no. 13	
---	--	--------------	--	--	--	---	--	--	--	--	--

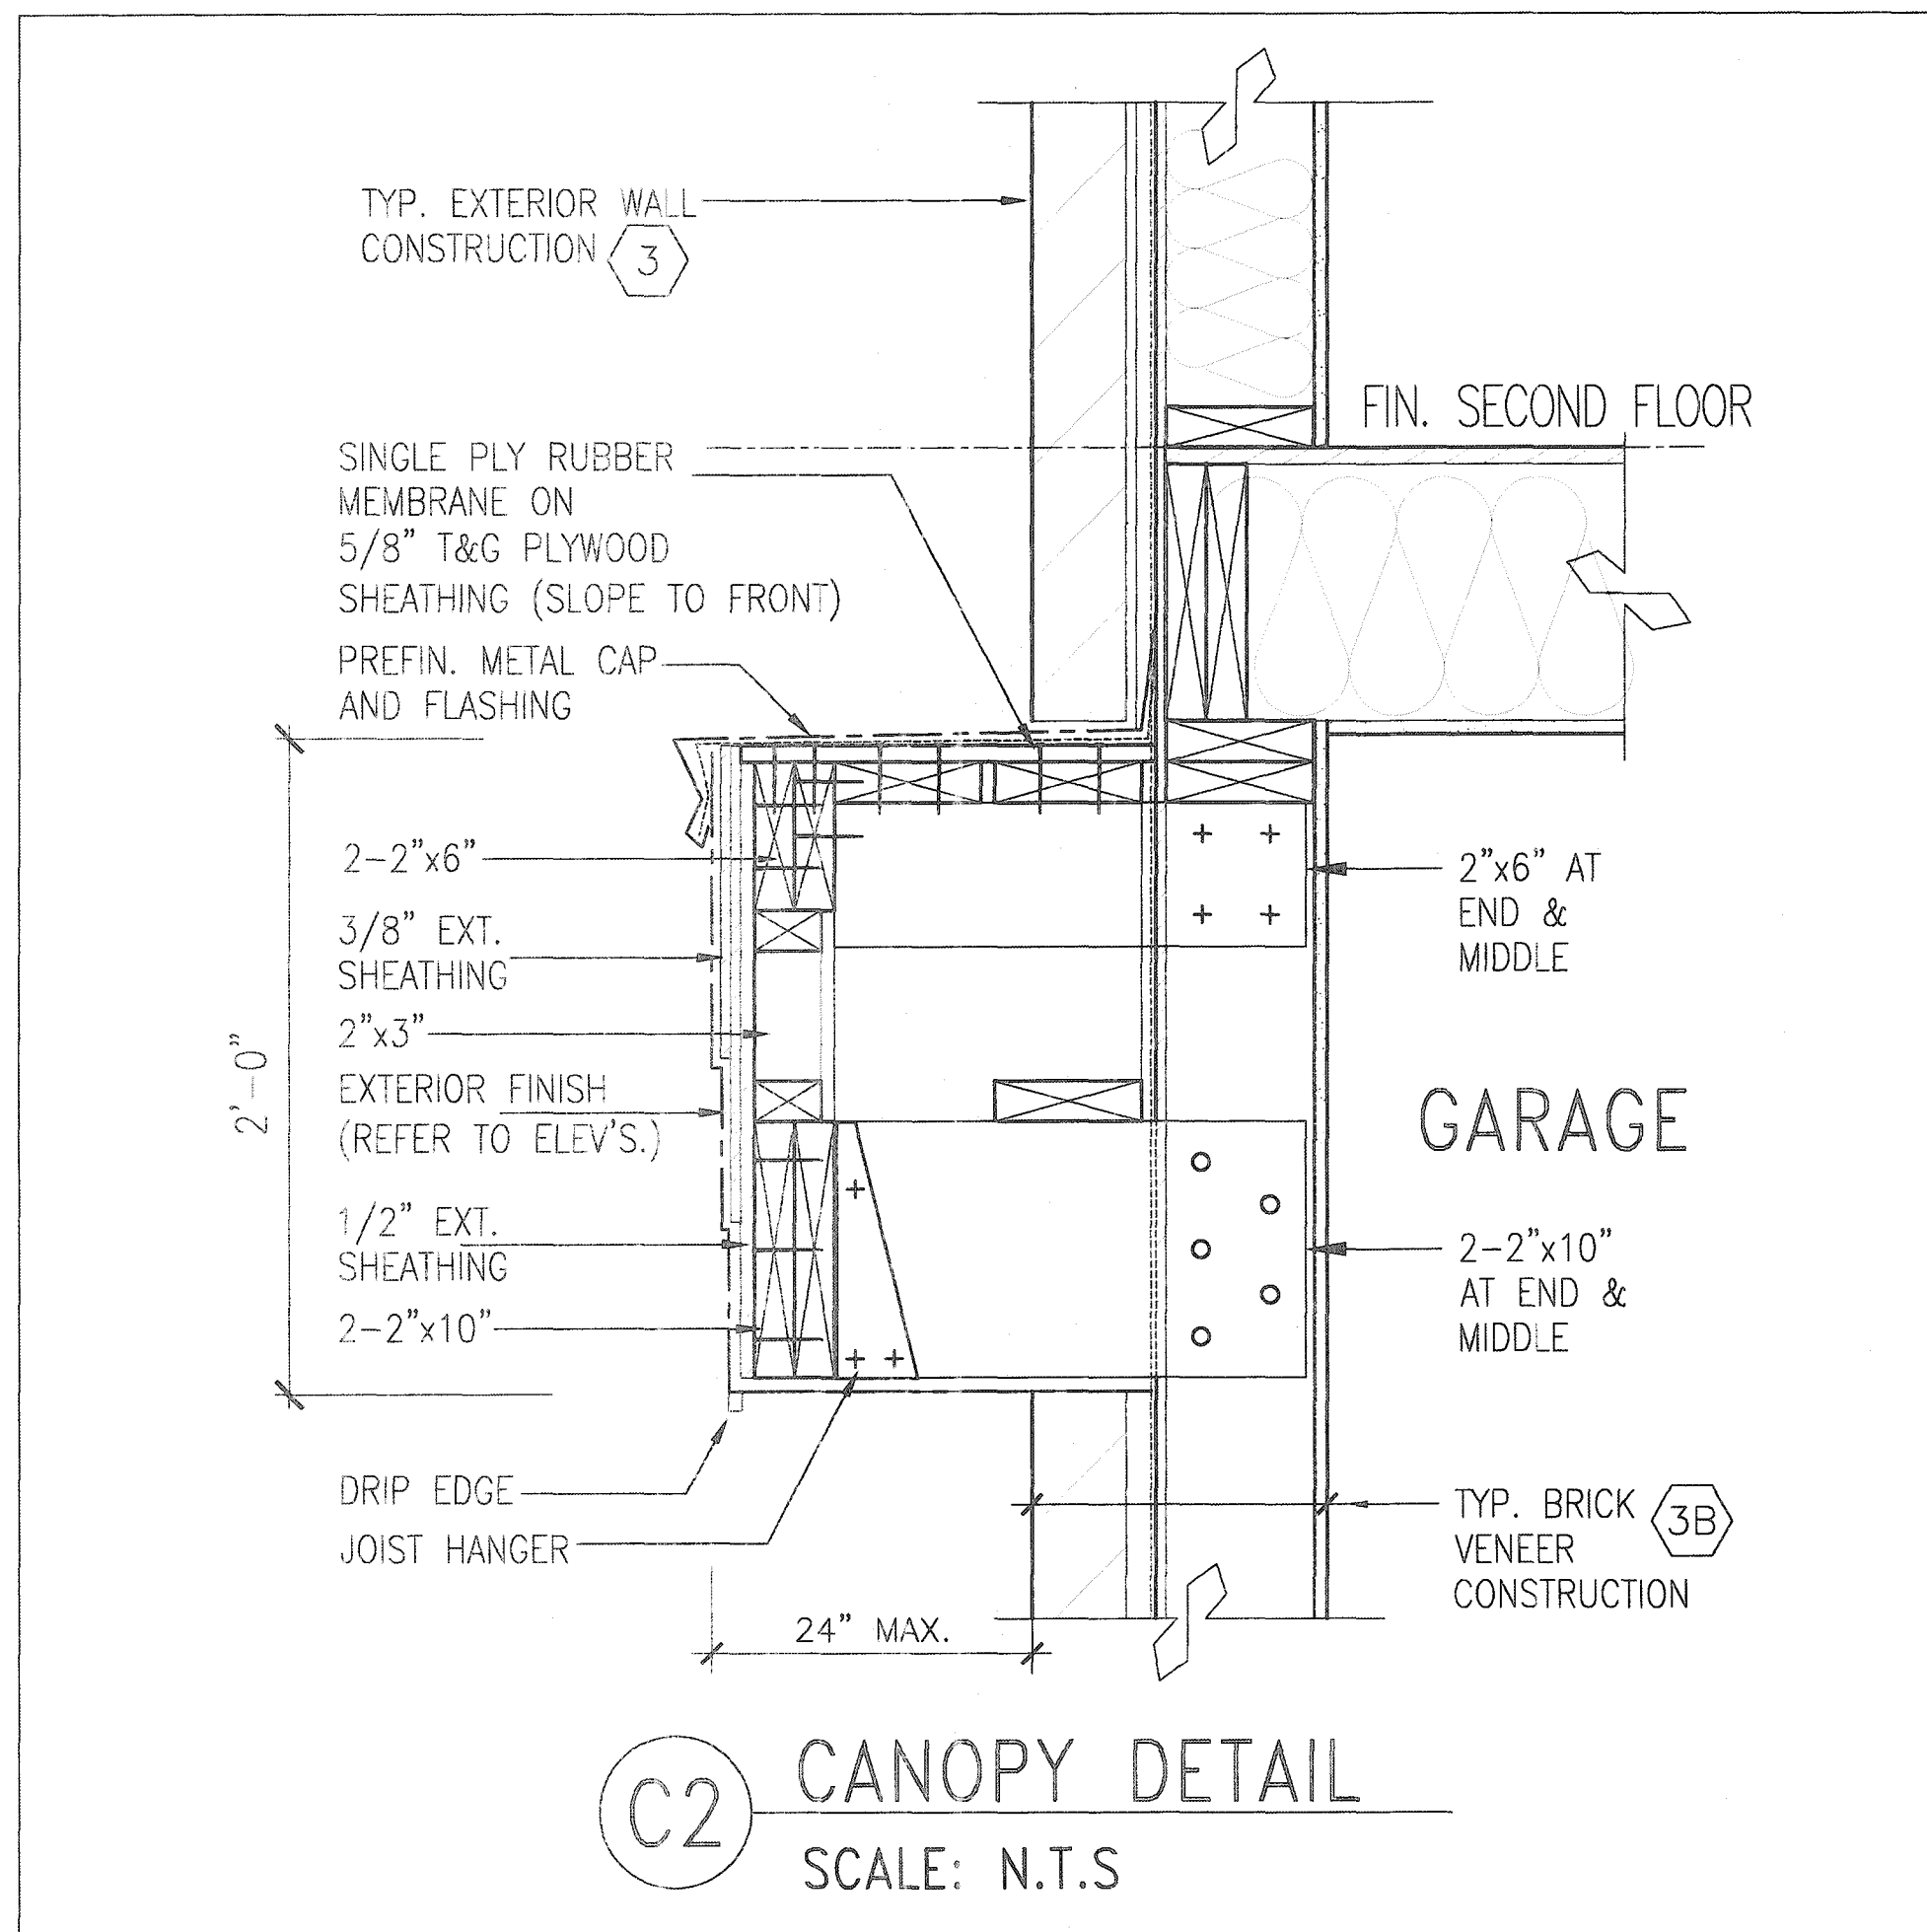

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department
FEB 05 2021
REC'D BY _____ DATE _____
REF'D TO _____ DATE _____

CITY OF HAMILTON
Building Division
Permit No. 21-102430
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
Don Smith Feb. 24, 2021
FOR CHIEF BUILDING OFFICIAL DATE

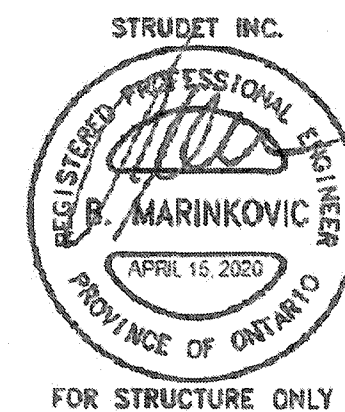

2012 CODE
COMPLIANCE PACKAGE A1

9. _____ 8. _____ 7. _____ 6. _____ 5. _____ 4. _____ 3. _____ 2. _____ 1. ISSUED FOR PERMIT. date by	The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. qualification information Richard Vink 24488 signature BCB VA3 Design Inc. 42658 Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.	VA3 DESIGN 255 Consumers Rd Suite 120 Toronto ON M2M 1R4 t 416.630.2255 f 416.630.4782 va3design.com	Greenpark. project name <u>RUSSELL GARDENS PH. 3</u> municipality <u>WATERDOWN</u> date <u>APRIL 2020</u> checked by _____ made _____ drawn by <u>GW</u> Not to Scale	SINGLES project no. <u>19014</u> drawing no. <u>14</u> 19014-GP-STD_DETAILS_A1
---	---	---	--	---

All drawings, specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.