

CONSTRUCTION NOTES (Unless otherwise noted)

ALL CONSTRUCTION TO ADHERE TO THESE PLANS AND SPEC'S AND TO CONFORM TO THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE CODES AND AUTHORITIES HAVING JURISDICTION. THESE REQUIREMENTS ARE TO BE TAKEN AS MINIMUM SPECIFICATIONS. ONT. REG. 332/12-2012 OBC.

1. ROOF CONSTRUCTION

NO.1210 (10.2kg/m²) ASPHALT SHINGLES, 10mm (3/8") PLYWOOD SHEATHING WITH "H" CLIPS, APPROVED WOOD TRUSSES @ 610mm (24") O.C. MAX. APPROVED EAVES PROTECTION TO EXTEND 500mm (2'-0") FROM EDGE OF ROOF AND MIN. 300mm (12") BEYOND INNER FACE OF EXTERIOR WALL. LEAVES PROTECTION NOT REQ'D FOR ROOF SLOPES 8:12 OR GREATER. 38x89 (2'x4") TRUSS BRACING @ 1830mm (6'-0") O.C. AT BOTTOM CHORD. PIERCE ALUM. EAVESGROUSE, FASCIA, RAIL & VENTED SOFFIT. PROVIDE ICE & WATER SHEED TO ALL ROOF/WALL SURFACES SUSCEPTIBLE TO ICE DAMMING. ROOF SHEATHING TO BE FASTENED 150 (6") C/C ALONG EDGES & INTERMEDIATE SUPPORTS WHEN TRUSSES SPACED GREATER THAN 406 (16"). ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH MIN. 25% AT EAVES & MIN. 25% AT ROOF (OBC 9.16.1.2).

FRAME WALL CONSTRUCTION (2'x6") (SB-12-TABLE 3.1.1.2.A)
SIDING AS PER ELEV. 15x39 (1'x2") VERTICAL WOOD FURRING, CONTIN. SHEATHING MEMBRANE, 11mm (7/16") EXT. TYPE SHEATHING OR OBC COMPLIANT EQUIVALENT, 38x140 (2'x4") STUDS @ 406mm (16") O.C. RSI 3.87 (R22) INSULATION AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm (1/2") INT. DRYWALL FINISH. SIDING TO BE MIN. 200mm (8") ABOVE FINISH GRADE. REFER TO OBC SB-12, CHAPTER 3 FOR REQUIRED MINIMUM THERMAL INSULATION REQUIREMENTS.

FRAME WALL CONSTRUCTION (2'x6") - GARAGE WALLS
SIDING AS PER ELEV. 15x39 (1'x2") VERTICAL WOOD FURRING, CONTIN. SHEATHING MEMBRANE, 11mm (7/16") EXT. TYPE SHEATHING OR OBC COMPLIANT EQUIVALENT, 38x89 (2'x4") STUDS @ 406mm (16") O.C. (MAX. HEIGHT 3000mm (9'-10")) WITH APPR. DIAGONAL WALL BRACING. REFER TO NOTE 19 WHERE FLOOR EXISTS ABOVE GARAGE. SIDING TO BE MIN. 200mm (8") ABOVE FINISH GRADE.

STUCCO WALL CONSTRUCTION (2'x6") (SB-12-TABLE 3.1.1.2.A)
STUCCO CLADDING SYSTEM CONFORMING TO OBC 9.27.1.1.(2) & 9.28 THAT EMPLOY A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED PER MANUFACTURERS SPECIFICATIONS ON 25mm (1") MIN. EXTRUDED OR EXPANDED RIGID POLYSTYRENE ON APPR. AIR/MOISTURE BARRIER ON 38x140 (2'x4") STUDS @ 406 (16") O.C. RSI 3.87 (R22) BATT INSUL. APPR. 6 MIL POLYETHYLENE VAPOUR BARRIER, 13mm (1/2") GYPSUM BOARD INTERIOR FINISH. STUCCO TO BE MIN. 200 (8") ABOVE FINISH GRADE. REFER TO OBC SB-12, CHAPTER 3 FOR REQUIRED MINIMUM THERMAL INSULATION REQUIREMENTS.

STUCCO WALL CONSTRUCTION (2'x6") - GARAGE WALLS
STUCCO CLADDING SYSTEM CONFORMING TO OBC 9.27.1.1.(2) & 9.28 THAT EMPLOY A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 25mm (1") MIN. EXTRUDED OR EXPANDED RIGID POLYSTYRENE ON APPROVED AIR/MOISTURE BARRIER ON 38x89 (2'x4") STUDS @ 406 (16") O.C. (MAX. HEIGHT 3000mm (9'-10")) WITH APPR. DIAGONAL WALL BRACING. REFER TO NOTE 19 WHERE FLOOR EXISTS ABOVE GARAGE. STUCCO TO BE MIN. 200 (8") ABOVE FINISH GRADE.

WALLS ADJACENT TO ATTIC - NO CLADDING
11mm (7/16") EXT. TYPE SHEATHING OR OBC COMPLIANT EQUIVALENT, 38x140 (2'x4") STUDS @ 406mm (16") O.C. RSI 3.87 (R22) INSULATION AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm (1/2") INTERIOR DRYWALL FINISH. MID-HEIGHT BLOCKING REQ'D IF NO SHEATHING APPLIED. REFER TO OBC SB-12, CHAPTER 3 FOR ADDITIONAL THERMAL INSULATION REQUIREMENTS.

BRICK VENEER CONSTRUCTION (2'x6") (SB-12-TABLE 3.1.1.2.A)
90mm (4") FACE BRICK, 25mm (1") AIR SPACE, 22x180x70mm (7/8"x7"x3") GALV. METAL TIES @ 406mm (16") O.C. HORIZONTAL 610mm (24") O.C. VERTICAL. APPROVED SHEATHING PAPER, 11mm (7/16") EXT. TYPE SHEATHING OR OBC COMPLIANT EQUIVALENT, 38x140 (2'x4") STUDS @ 406mm (16") O.C. RSI 3.87 (R22) INSULATION AND APPR. VAPOUR BARRIER WITH APPROVED CONTIN. AIR BARRIER, 13mm (1/2") INT. DRYWALL FINISH. PROVIDE WEEP HOLES @ 900mm (32") O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER. BRICK TO BE MIN. 150mm (6") ABOVE FINISH GRADE. REFER TO OBC SB-12, CHAPTER 3 FOR REQUIRED MINIMUM THERMAL INSULATION REQUIREMENTS.

BRICK VENEER CONSTRUCTION (2'x6") - GARAGE WALLS
90mm (4") FACE BRICK, 25mm (1") AIR SPACE, 22x180x70mm (7/8"x7"x3") GALV. METAL TIES @ 406mm (16") O.C. HORIZONTAL 610mm (24") O.C. VERTICAL. APPROVED SHEATHING PAPER, 11mm (7/16") EXT. TYPE SHEATHING OR OBC COMPLIANT EQUIVALENT, 38x89 (2'x4") STUDS @ 406mm (16") O.C. (MAX. HEIGHT 3000mm (9'-10")) WITH APPROVED DIAGONAL WALL BRACING. REFER TO NOTE 19 WHERE FLOOR EXISTS ABOVE GARAGE. PROVIDE WEEP HOLES @ 900mm (32") O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER. BRICK TO BE MIN. 150mm (6") ABOVE FINISH GRADE.

STUCCO WALL CONSTRUCTION (2'x6") (SB-12-TABLE 3.1.1.2.A)
STUCCO CLADDING SYSTEM CONFORMING TO OBC 9.27.1.1.(2) & 9.28 THAT EMPLOY A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 25mm (1") MIN. EXTRUDED OR EXPANDED RIGID POLYSTYRENE ON APPR. CONTIN. AIR/MOISTURE BARRIER ON 38x140 (2'x4") STUDS @ 406mm (16") O.C. RSI 3.87 (R22) BATT INSUL. APPR. 6 MIL POLYETHYLENE VAPOUR BARRIER, 13mm (1/2") GYPSUM BOARD INTERIOR FINISH. STUCCO TO BE MIN. 200 (8") ABOVE FINISH GRADE. REFER TO OBC SB-12, CHAPTER 3 FOR REQUIRED MINIMUM THERMAL INSULATION REQUIREMENTS.

INTERIOR STUD PARTITIONS

FOR BEARING PARTITIONS 38x89 (2'x4") @ 406mm (16") O.C. FOR 2 STOREYS AND 305mm (12") O.C. FOR 3 STOREYS. NON-BEARING PARTITIONS 38x89 (2'x4") @ 610mm (24") O.C. PROVIDE 38x89 (2'x4") BUTTON PLATE AND 2/38x89 (2'x4") TOP PLATE, 13mm (1/2") INT. DRYWALL BOTH SIDES OF STUDS. PROVIDE 38x140 (2'x4") STUDS/PLATES NOTED.

FOUNDATION WALL/FOOTINGS (9.15.3, 9.15.4, 9.13.2, 9.14.2.1, 9.14.2.2)
200mm (8") POURED CONC. FTH. WALL 15MPa (2200psi) WITH BURENDAIR DAMPPROOFING AND DRAINAGE LAYER. DRAINAGE LAYER REQ'D. WHEN BASEMENT INSUL. EXTENDS 900 (2'-11") BELOW FIN. GRADE. DRAINAGE LAYER IS NOT REQ'D IF FOUNDATION WALL IS WATERPROOFED. MAXIMUM POUR HEIGHT 2300 (7'-10") ON 505x155 (20"x6") CONTINUOUS KEYED CONC. FTG. BRACE FTH. WALL PRIOR TO BACKFILLING. ALL FOOTINGS SHALL REST ON NATURAL UNDISTURBED SOIL OR COMPACTED ENGINEERED FILL.

STRIP FOOTINGS - FOR TOWNHOUSES
FOR STRIP FOOTING SIZES REFER TO BLOCK FOUNDATION PLAN. ASSUMED 120 KPa (15 psf) SOIL BEARING CAPACITY FOR TOWNHOUSES, TO BE VERIFIED ON SITE.

MAXIMUM FLOOR LIVE LOAD OF 2.4KPa (50psf) PER FLOOR. REFER TO SOILS REPORT FOR SOIL CONDITIONS AND BEARING CAPACITY.

FOUNDATION DRAINAGE (OBC 9.14.2 & 9.14.3)
100mm (4") DIA. FOUNDATION DRAINAGE TILE 150mm (6") CRUSHED STONE OVER AND AROUND DRAINAGE TILES.

BASEMENT SLAB (OBC 9.13.1.1(b), 9.14.4.4(1), 9.25.3.3.1(e))
80mm (3") MIN. 25MPa (3600psi) CONC. SLAB ON 100mm (4") COARSE GRANULAR FILL OR 200MPa (3000psi) CONC. WITH DAMPPROOFING BELOW SLAB UNDER SUB INSULATION PER SB-12; 3.1.1.7(5)(e) where required. ALL SLAB JOINTS & PENETRATIONS TO BE SEALED TO MAINTAIN AIR BARRIER.

WOOD SUBFLOORS (SEE OBC 9.23.1.4 & 9.23.2.1)
19mm (3/4") MIN. T & G SUBFLOOR UNDER GROUND FLOOR FINISH FLOOR.
18mm (3/4") T&G SUBFLOOR UNDER SECOND FLOOR FINISH FLOOR.
16mm (5/8") PANEL-TYPE UNDERLAY FOR CERAMIC TILE APPLICATION. 6mm (1/4") PANEL-TYPE UNDERLAYMENT UNDER RESILIENT & PARQUET FLOORING.

ATTIC INSULATION (SB-12-TABLE 3.1.1.2.A) (SB-12-3.1.1.8)
RSI 1.55 (R10) BLOWN IN ROOF INSULATION AND APPROVED VAPOUR BARRIER, 15mm (5/8") INT. DRYWALL FINISH OR APPROVED EQUAL. RSI 3.52 (R20) MIN. ABOVE INNER SURFACE OF EXTERIOR WALL.

ALL STAIRS/EXTERIOR STAIRS - OBC 9.8 -
UNIFORM RISE - 150mm (6") MAX. BETWEEN ADJACENT TREADS OR LANDINGS.
-100mm (4") MAX. BETWEEN TALLEST & SHORTEST RISE IN FLIGHT.

MAX. RISE = 200 (7'-7/8")
MIN. RUN = 210 (8'-1/4")
MIN. TREAD = 235 (9'-1/4")
MAX. NOSING = 25 (1")
MIN. HEADROOM = 1950 (6'-5")
RAIL @ LANDING = 900 (2'-11")
RAIL @ STAIR = 865 (2'-10") TO 965 (3'-2")
MIN. STAIR WIDTH = 860 (2'-10")

FOR CURVED STAIRS
MIN. RUN = 150 (6")
MIN. AVG. RUN = 200 (8")

HANDRAILS - OBC 9.8.7 -
FINISHED RAILING ON PICKETS SPACED MAXIMUM 100mm (4") BETWEEN PICKETS. CLEARANCE BETWEEN HANDRAIL AND SURFACE BEHIND IT TO BE 50 (2") MIN. HANDRAILS TO BE CONTINUOUS EXCEPT FOR NEWEL POST AT CHANGES OF DIRECTION.

INTERIOR GUARDS - OBC 9.8.8 -
INTERIOR GUARDS: 900mm (2'-11") MIN. HIGH.

EXTERIOR GUARDS - OBC 9.8.8 -
900mm (32") HIGH GUARD WHERE DISTANCE FROM PORCH TO FIN. GRADE IS LESS THAN 1800mm (71") 1070mm (42") HIGH GUARD IS REQUIRED WHERE DISTANCE EXCEEDS 1800mm (71").

SILL PLATE ANCHORAGE
38x89 (2'x4") SILL PLATE WITH 13mm (1/2") DIA. ANCHOR BOLTS 200mm (8") LONG, EMBEDDED MIN. 100mm (4") INTO CONC. @ 2400mm (7'-10") O.C. CAPPING OR 25 (1") MIN. MINERAL WOOL BETWEEN PLATE AND TOP OF FTH. WALL. USE NON-SHRINK GROUT TO LEVEL SILL PLATE WHEN REQUIRED.

BASEMENT INSULATION (SB-12-3.1.1.7) 9.25.3.3.1(e), 9.13.2.1
FOUNDATION WALLS ENCLOSING HEATED SPACE SHALL BE INSULATED FROM THE UNDERSIDE OF THE SUBFLOOR TO NOT MORE THAN 200mm (8") ABOVE THE FINISHED FLOOR & NO CLOSER THAN 30mm (1") OF THE BASEMENT SLAB. RSI 3.52 (R20) BLANKET INSULATION TO HAVE APPROVED VAPOUR BARRIER RECOMMEND DAMPPROOF WITH BUILDING PAPER BETWEEN THE FOUNDATION WALL AND INSULATION UP TO GRADE LEVEL. NOTE: FULL HEIGHT INSULATION AT COLD CELLAR WALLS AIR BARRIER TO BE SEALED TO FOUNDATION WALL WITH CHALKLINE. CONTINUOUS INSULATION (ci) IS NOT TO BE INTERRUPTED BY FRAMING.

BASEMENT BEARING STUD PARTITION
38x89 (2'x4") STUDS @ 406mm (16") O.C. 38x89 (2'x4") SILL PLATE ON DAMPPROOFING MATERIAL, 13mm (1/2") DIA. ANCHOR BOLTS 200mm (8") LONG, EMBEDDED MIN. 100mm (4") INTO CONC. @ 2400mm (7'-10") O.C. 100mm (4") HIGH CONC. CURB ON 305x155 (12"x6") CONC. FOOTING. ADD HOZ. BLOCKING AT MIN. HEIGHT IF WALL IS UNFINISHED.

STEEL BASEMENT COLUMN (SEE OBC 9.15.3.3)
89mm (3-1/2") DIA x 4.78mm (0.188") STL. COL. WITH A MIN. CAPACITY OF 0.89MN (240000lbs) WITH 150x150x5 (2-1/2"x12"x2") DE COLUMN TO STUD WALL WITH 2-32x3.175 (1-1/8"x1/8") STEEL STRAP WELDED TO COLUMN AND FASTENED TO STUD WITH 2-S25 6.35x38 (1/4"x1-1/2") SCREWS MANUF. BY SIMPSON STRONG TIE.

STEEL COLUMN
90mm (3-1/2") DIA x 4.78mm (0.188") STL. COL. WITH 100x100x6 (4"x4"x1/4") TOP & BOTTOM PLATES. FIELD WELD BOTTOM PLATE TO 100x250x12.5 (4"x10"x1/2") BASE PLATE C/W 2-12mm DIA. x 300mm LONG x50mm HOOD ANCHORS (2-1/2"x12"x2"). DE COLUMN TO STUD WALL WITH 2-32x3.175 (1-1/8"x1/8") STEEL STRAP WELDED TO COLUMN AND FASTENED TO STUD WITH 2-S25 6.35x38 (1/4"x1-1/2") SCREWS MANUF. BY SIMPSON STRONG TIE.

CONCRETE PLASTER

BEAM POCKET OR 200x200 (8"x8") POURED CONC. N3 WALLS. MIN. BEARING 30mm (1-1/2")

19x26 (1"x2") CONTINUOUS WOOD STRAPPING BOTH SIDES OF STEEL BEAM. (OBC 9.23.4.3.3(c))

GARAGE SLAB

100mm (4") 32MPa (4640psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT ON OPTIONAL 100 (4") COARSE GRANULAR FILL WITH COMPACTED SUB-BASE OR COMPACTED NATIVE FILL. SLOPE TO FRONT (EXTERIOR) AT 1% MIN.

INTERIOR GARAGE WALLS & CEILING (SB-12-TABLE 3.1.1.2.A)

13mm (1/2") GYPSUM BOARD ON WALL AND CEILING BETWEEN HOUSE AND GARAGE. RSI 3.57 (R22) IN WALLS, RSI 5.46 (R31) IN CEILING. TAP AND SEAL ALL JOINTS AIRTIGHT PER O.B.C. 9.10.9.16. REFER TO SB-12, TABLE 3.1.1.2.A. FOR REQUIRED THERMAL INSULATION.

DOOR AND FRAME GASPROOFED. DOOR EQUIPPED WITH SELF CLOSING DEVICE AND WEATHERSTRIPPING PER OBC 9.10.13.15.

EXTERIOR STEP
PRECAST CONCRETE STEP OR WOOD STEP WHERE NOT EXPOSED TO WEATHER. MAX. RISE 200mm (7'-7/8") MIN. TREAD 250mm (9'-27/32"). SEE OBC 9.8.9.2, 9.8.9.3 & 9.8.10.

DRYED VENT (OBC 9.23.8.7.1, 6.6.2.4.1)
CAPPED DRYER EXHAUST VENTED TO EXTERIOR. (USE 100mm (4") DIA. SMOOTH WALL VENT PIPE).

INSULATED ATTIC ACCESS (OBC 9.13.2.1, 9.13.2.1.1)
ATTIC ACCESS HATCH WITH MIN. DIMENSION OF 545x700mm (21'-1/2"x27'-1/2") & MIN. AREA OF 0.32 SQ.M. (3.44 SQ.FT.) WITH WEATHERSTRIPPING. RSI 3.52 (R20) RIGID INSULATION BACKING. SEE OBC SB-12, 3.1.1.8.

FIREPLACE CHIMNEYS - OBC 9.21 -
TOP OF FIREPLACE CHIMNEY SHALL BE 910mm (3'-0") ABOVE THE HIGHEST POINT AT WHICH IT COMES IN CONTACT WITH THE ROOF AND 610mm (2'-0") ABOVE THE ROOF SURFACE WITHIN A HORIZ. DISTANCE OF 3050mm (10'-0") FROM THE CHIMNEY.

LINEN CLOSETS
4 SHELVES MIN. 350mm (14") DEEP.

MECHANICAL EXHAUST
MECHANICAL EXHAUST FAN, VENTED TO EXTERIOR AS REQUIRED BY OBC 9.32.3.5 & 9.32.3.10.

STEEL BEARING PLATE FOR MASONRY WALLS
280x280x15 (11"x11"x5/8") STL. PLATE FOR STL BEAMS AND 280x280x12 (11"x11"x1/2") STL. PLATE FOR WOOD BEAMS. BEARING ON CONC. BLOCK PARTYWALL, ANCHORED WITH 2-19mm (3/4") x 200mm (8") LONG GALV. ANCHORS WITHIN SOLID BLOCK COURSE. LEVEL WITH NON-SHRINK GROUT.

SOLID WOOD BEARING FOR WOOD STUD WALLS
SOLID BEARING TO BE AT LEAST AS WIDE AS THE SUPPORTED MEMBER. SOLID WOOD BEARING COMPOSED OF BUILT-UP WOOD STUDS TO BE CONSTRUCTED IN ACCORDANCE WITH OBC 9.17.4.2(2).

CLASS 'B' VENT
U.L.C. RATED CLASS 'B' VENT 610mm (2'-0") ABOVE THE POINT IN CONTACT WITH THE ROOF FOR SLOPES UP TO 9:12. REFER TO THE ONTARIO GAS UTILIZATION CODE.

BASEMENT WOOD POST (OBC 9.12.4.1)
3-38x140 (3'-2") BUILT-UP POST ON METAL BASE SHOE ANCHORED TO CONC. WITH 12.7 DIA. BOLTS 406x406x203 (16"x16"x8") CONC. FTG. OR AS OTHERWISE SPECIFIED ON DRAWING.

STEPPED FOOTINGS (OBC 9.15.3.9)
MIN. HORIZ. STEP = 600mm (24")
MAX. VERT. STEP = 600mm (24")

SLAB ON GRADE
MIN. 100mm (4") CONCRETE SLAB ON GRADE ON 100mm (4") COARSE GRANULAR FILL REINFORCED WITH 6-16mm (5/8") MESH PLACED NEAR MID-DEPTH OF SLAB. CONC. STRENGTH 32 MPa (4640 psi) WITH 5-8% AIR ENTRAINMENT ON COMPACTED SUB-GRADE UNDER SLAB INSULATION AS PER OBC SB-12 3.1.1.7(5)(e) AND SB-12, TABLE 3.1.1.2.A, where required. ALL JOINTS & PENETRATIONS OF INTERIOR SLABS TO BE SEALED TO MAINTAIN AIR BARRIER.

PAID FOOTINGS
120 KPa. ENGINEERED FILL SOIL
F1 = 42"x42"x18" CONCRETE PAD F1 = 48"x48"x20" CONCRETE PAD
F2 = 35"x35"x18" CONCRETE PAD F2 = 40"x40"x18" CONCRETE PAD
F3 = 30"x30"x12" CONCRETE PAD F3 = 34"x34"x14" CONCRETE PAD
F4 = 24"x24"x12" CONCRETE PAD F4 = 28"x28"x12" CONCRETE PAD
F5 = 16"x16"x8" CONCRETE PAD F5 = 18"x18"x8" CONCRETE PAD

(REFER TO FLOOR PLAN FOR UNUSUAL SIZE PADS NOT ON CHART)

DOOR SCHEDULE

NOS.	WIDTH	HEIGHT	HEIGHT	OR MORE	TYPE
		CEILING	10'		
1	2'-0"	8'-0"	8'-0"	0'-0"	INSULATED ENTRANCE DOOR
2	2'-0"	8'-0"	8'-0"	0'-0"	INSULATED FRONT DOORS
3	2'-0"	8'-0"	8'-0"	0'-0"	WOOD & GLASS DOOR
4	2'-0"	8'-0"	8'-0"	0'-0"	EXTERIOR SLAB DOOR
5	2'-0"	8'-0"	8'-0"	0'-0"	INTERIOR SLAB DOOR
6	2'-0"	8'-0"	8'-0"	0'-0"	INTERIOR SLAB DOOR
7	2'-0"	8'-0"	8'-0"	0'-0"	INTERIOR SLAB DOOR

WOOD LINDERS AND BEAMS

W1	W2	W3	W4	W5	W6	W7	W8	W9
3-1/2" x 3-1/2" x 1/4" (89x89x6.4)	3-1/2" x 3-1/2" x 1/4" (102x89x7.9)	3-1/2" x 3-1/2" x 1/4" (127x89x7.9)	3-1/2" x 3-1/2" x 1/4" (152x89x11.0)	3-1/2" x 3-1/2" x 1/4" (152x102x11.0)	3-1/2" x 3-1/2" x 1/4" (127x89x7.9)	3-1/2" x 3-1/2" x 1/4" (127x89x7.9)	3-1/2" x 3-1/2" x 1/4" (127x89x7.9)	3-1/2" x 3-1/2" x 1/4" (152x102x11.0)
2-2"x8" SPR. No.2	2-2"x8" SPR. No.2	2-2"x10" SPR. No.2	2-2"x12" SPR. No.2	2-2"x12" SPR. No.2	2-2"x12" SPR. No.2	2-2"x12" SPR. No.2	2-2"x10" SPR. No.2	2-2"x10" SPR. No.2

DIRECT VENTING GAS FURNACE VENT

DIRECT VENT FURNACE TERMINAL MIN. 900mm (36") FROM A GAS REGULATOR. MIN. 300mm (12") ABOVE FIN. GRADE. FROM ALL OPENINGS, EXHAUST AND INTAKE VENTS. HWY INTAKE TO BE A MIN. OF 1830mm (6'-0") FROM ALL EXHAUST TERMINALS. REFER TO GAS UTILIZATION CODE. ALL AIR INTAKES SHALL BE LOCATED SO THAT THEY ARE SEPARATED FROM KITCHEN EXHAUST BY 3.0M IN COMPLIANCE WITH O.B.C. DIV-B TABLE 6.2.3.12.

DIRECT VENTING GAS FIREPLACE VENT

DIRECT VENT GAS FIREPLACE VENT TO BE A MINIMUM 300mm (12") FROM ANY OPENING AND ABOVE FIN. GRADE. REFER TO GAS UTILIZATION CODE.

JOIST STRAPPING AND BRIDGING (SEE OBC 9.23.9.4)

16mm (5/8") T & G SUBFLOOR ON WOOD FLOOR JOISTS. FOR CERAMIC TILE APPLICATION (SEE OBC 9.30.6.4) 6mm (1/4") PANEL TYPE UNDERLAY UNDER RESILIENT & PARQUET FLOORING. (SEE OBC 9.30.2.4)

FLOOR JOISTS WITH SPANS OVER 2100mm (6'-11") TO BE BRIDGED WITH 38x38 (2'x2") CROSS BRACING OR SOLID BLOCKING @ 2100mm (6'-11") O.C. MAX. AND WHERE SPECIFIED BY JOIST TABLES A-1 OR A-2 STRAPPING SHALL BE 19x64 (1'x3") @ 2100mm (6'-11") O.C. UNLESS A PANEL TYPE CEILING FINISH IS APPLIED. (SEE OBC 9.23.9.4.4)

EXPOSED BUILDING FACE - OBC 9.10.15

EXTERIOR WALLS TO HAVE A FIRE RESISTANCE RATING OF NOT LESS THAN 45 min. WHERE LIMITING DISTANCE (LD) IS LESS THAN 1.2M (3'-11"). WHERE THE LD IS LESS THAN 600mm (2'-0") THE EXPOSING FACE SHALL BE CLAD IN NON-COMBUSTIBLE MATERIAL. SEE ELEVATIONS FOR ADDITIONAL NOTES.

COLD CELLAR PORCH SLAB (OBC 9.39.1)

FOR MAX. 2500 mm (8'-2") PORCH DEPTH (SHORTEST DIM.), 125mm (4 7/8") 32MPa (4640psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT, REIN. WITH 10M BARS @ 200mm (7 7/8") O.C. EACH WAY IN BOTTOM THIRD OF SLAB, 600x600 (23 5/8" x 23 5/8") 10M CONCRETE @ 600mm (23 5/8") O.C. ANCHORED IN PERIMETER FTH. WALLS. SLOPE SLAB MIN. 1.0% FROM DOOR SLAB TO HAVE MIN 75mm (3") BEARING ON FTH. WALLS. PROVIDE (1) UNTELS OVER CELLAR DOOR AND WITH 100mm (4") END BEARING.

BRICK CHECK

THE FTH. WALL SHALL NOT BE REDUCED TO LESS THAN 90mm (3-1/2") THICK TO A MAX. DEPTH OF 600mm (28") AND SHALL BE TIED TO THE FACING MATERIAL WITH METAL TIES SPACED 200mm (8") O.C. VERTICALLY AND 800mm (36") O.C. HORIZONTALLY. FILL SPACE BETWEEN WALL AND FACING SOLID WITH MORTAR.

CONVENTIONAL ROOF FRAMING (20KPa. SNOW LOAD)

38x140 (2'x4") RAFTERS @ 406mm (16") O.C. FOR MAX 11'-7" SPAN, 38x184 (2'x6") RIDGE BOARD, 38x89 (2'x4") COLLAR TIES AT MIDSPAN. CEILING JOISTS TO BE 38x89 (2'x4") @ 406mm (16") O.C. FOR MAX. 2330mm (9'-3") SPAN & 38x140 (2'x4") @ 406 (16") O.C. FOR MAX. 4450mm (14'-7") SPAN.

RAFTERS FOR BUILT-UP ROOF TO BE 38x89 (2'x4") @ 610mm (24") O.C. WITH A 38x89 (2'x4") CENTRE POST TO THE TRUSS BELOW, LATERALLY BRACED @ 1800mm (6'-0") O.C. VERTICALLY.

TWO STOREY VOLUME SPACES

FOR A MAXIMUM 5490 mm (18'-0") HEIGHT AND MAXIMUM SUPPORTED ROOF TRUSS LENGTH OF 6.0m, PROVIDE 2-38x140 (2'-2"x4") SPR#2 CONTIN. STUDS @ 305mm (12") O.C. (TRIPLE UP AT EVERY THIRD DOUBLE STUD FOR BRICK WALLS) C/W 9.6 (3/8") EXCK EXT. PLYWOOD SHEATHING. PROVIDE SOLID WOOD BLOCKING BETWEEN WOOD STUDS @ 1220 mm (4'-0") O.C. VERTICALLY. -FOR WALLS WITH HORIZ. DISTANCES NOT EXCEEDING 2900 mm (9'-6"). PROVIDE 38x140 (2'x4") STUDS @ 406 (16") O.C. WITH CONTINUOUS 2-38x140 (2'-2"x4") TOP PLATES & 1-38x140 (1'-2"x6") BOTTOM PLATE & MAXIMUM OF 3-38x184 (3'-2"x6") CONT. HEADER AT GRID. CEILING LEVEL TOE-NAILLED & GLUED AT TOP, BOTTOM PLATES AND HEADERS.

EXPOSED FLOOR TO EXTERIOR (SB-12-TABLE 3.1.1.2.A)

PROVIDE RSI 5.46 (R31) INSULATION, APPROVED VAPOUR BARRIER AND CONTINUOUS AIR BARRIER, FINISHED SOFFIT.

PARTYWALLS


TYPICAL 1 HOUR RATED PARTYWALL. REFER TO DETAILS FOR TYPE AND SPECIFICATIONS.

EXTERIOR WALLS FOR WALK-OUT CONDITIONS


THE EXTERIOR BASEMENT STUD WALL TO BE 38x140 (2'x6") STUDS @ 406mm (16") O.C. OR 38x89 (2'x4") STUDS @ 305mm (12") O.C.

WINDOWS

- 1) MINIMUM BEDROOM WINDOW - OBC 9.9.10.1-1
AT LEAST ONE BEDROOM WINDOW ON A GIVEN FLOOR IS TO HAVE MIN. 0.35m² UNOBSTRUCTED GLAZED OR OPENABLE AREA WITH MIN. CLEAR WIDTH OF 380 mm (1'-3")
- 2) WINDOW GUARDS - OBC 9.9.9.1.6
A GUARD IS REQUIRED WHERE THE TOP OF THE WINDOW SILL IS LOCATED LESS THAN 480mm (1'-7") ABOVE FIN. FLOOR AND THE DISTANCE FROM THE FIN. FLOOR TO THE ADJ

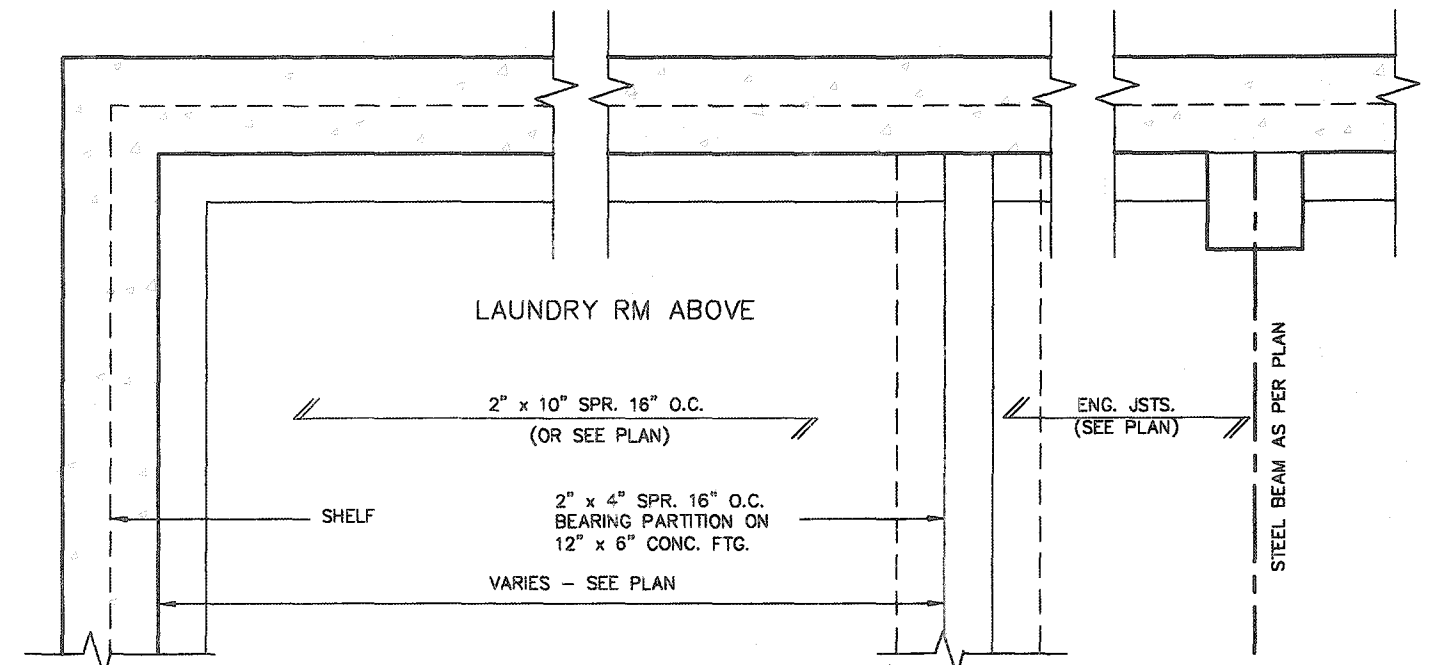

PARTIAL FOUNDATION PLAN

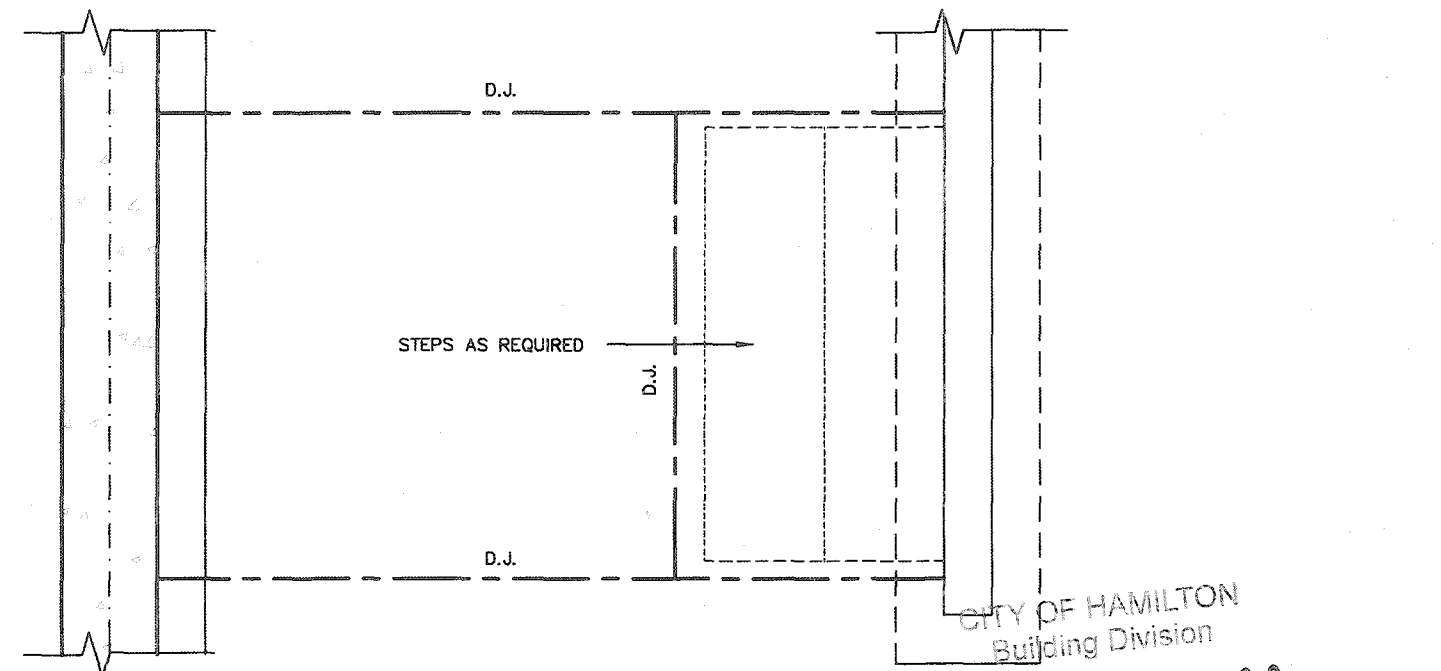

CITY OF HAMILTON
Building Division


Permit No. 21-103609

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

[Signature] **MAR 09 2021**
DATE

FOR CHIEF BUILDING OFFICIAL


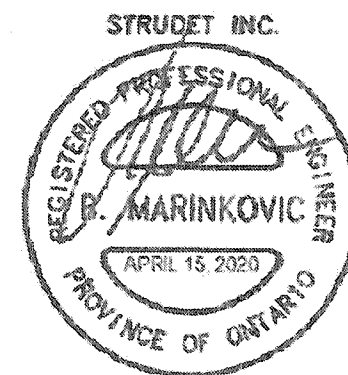


FOR STRUCTURE ONLY

2012 CODE
COMPLIANCE PACKAGE A1

[illegible]

All drawings specifications, related documents and design are the copyright property of VAS DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VAS DESIGN's written permission.

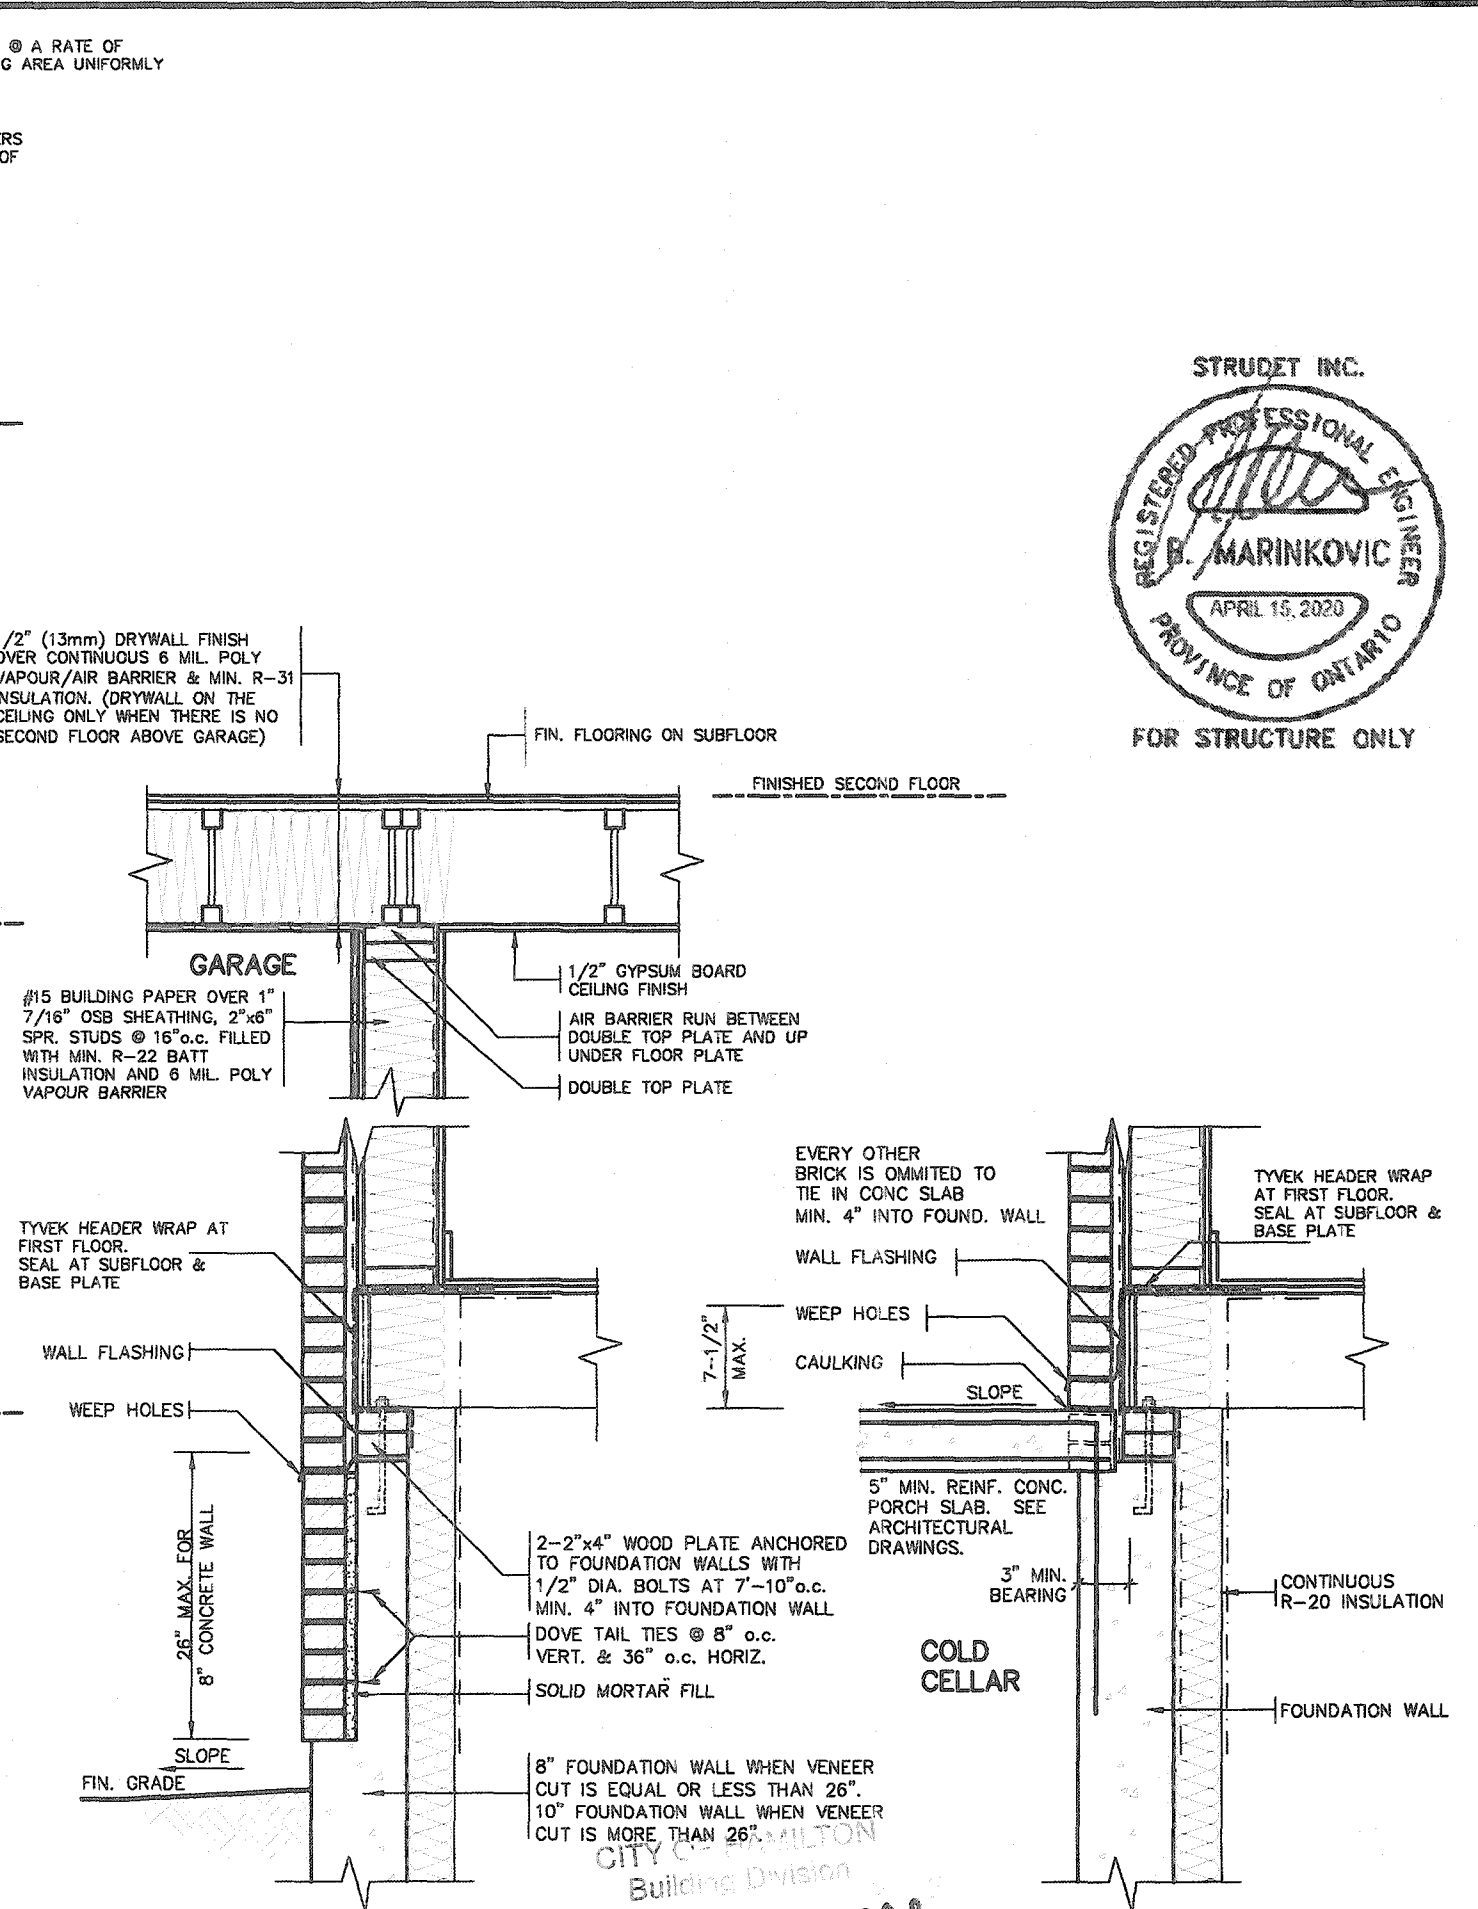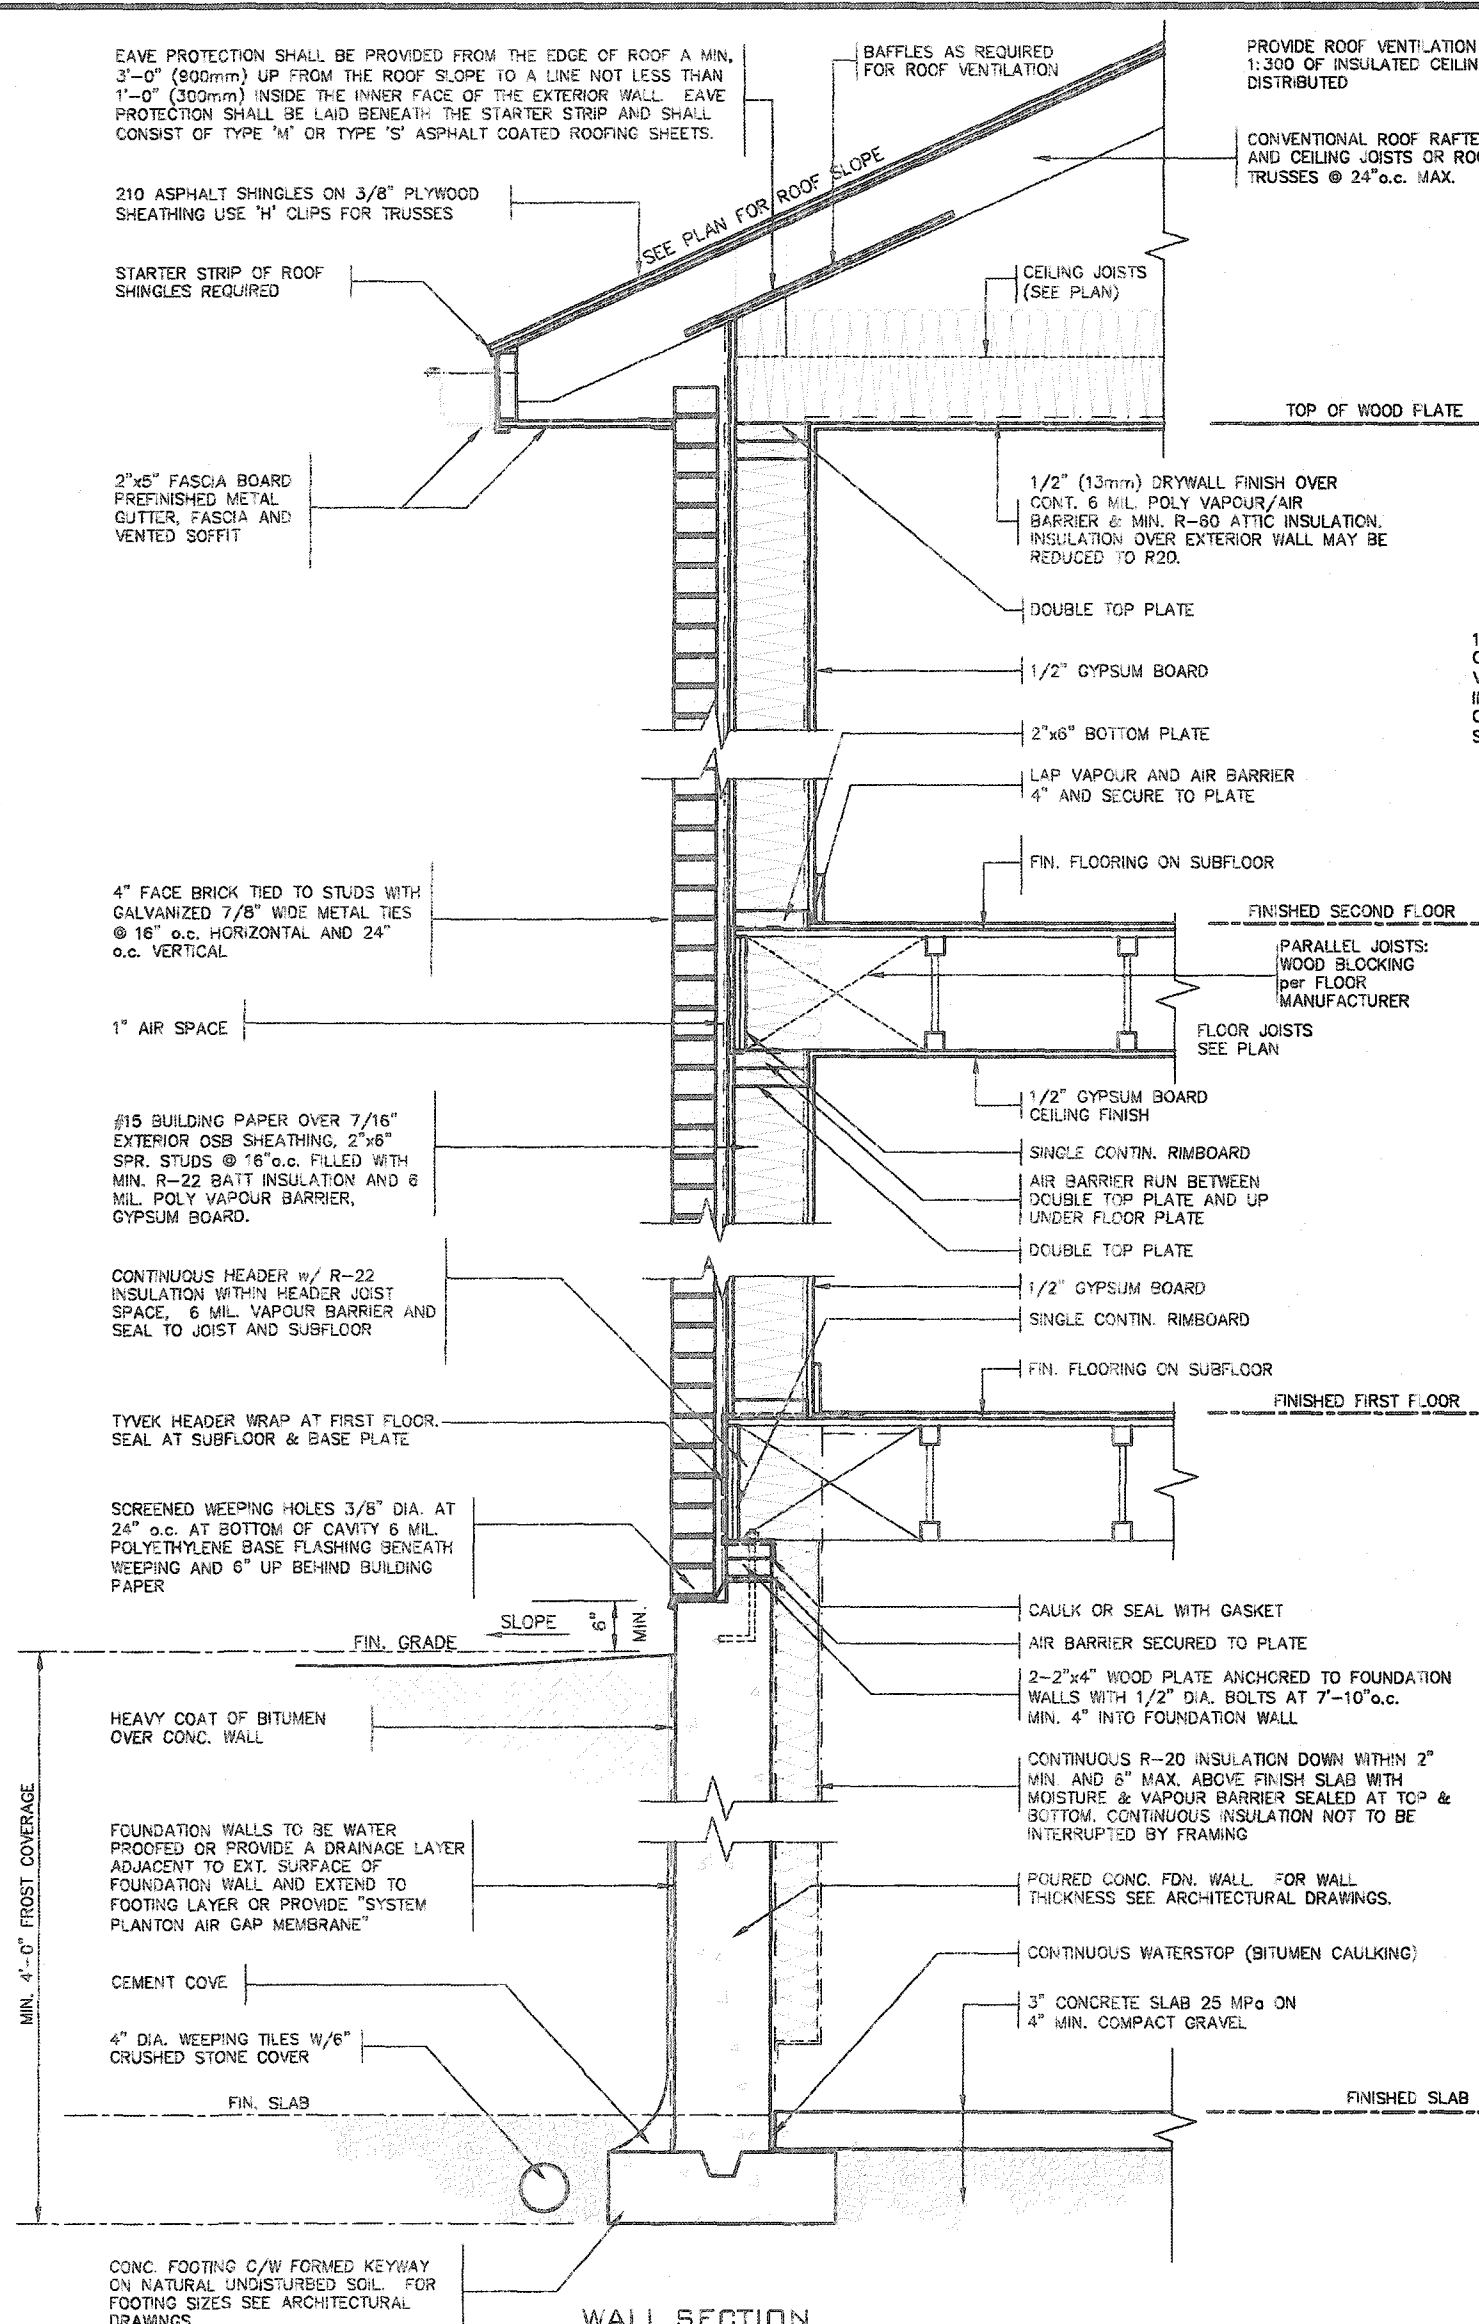

DETAIL FOR CONCRETE VENEER DROPPED GRADE Permit No. 21-103609

DETAIL FOR COLD CELLAR PORCH SLAB


THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW.

These drawings and specifications have been reviewed by **TAB** FOR CHIEF BUILDING OFFICIAL DATE **MAR 09 2021**


2012 CODE COMPLIANCE PACKAGE A1

1 ISSUED FOR PERMIT. A/R 13/20 GW	The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. Richard Vink 24488 BCN signature VA3 Design Inc. 42658 Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be copied.	VA3 DESIGN 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 va3design.com	Greenpark. project name RUSSELL GARDENS PH. 3 municipality WATERDOWN date APRIL 2020 checked by Not to Scale scale 2"x6" BRICK VENEER SECTIONS 19014-GP-STD-DETAILS_A1	SINGLES project no. 19014 drawing no. 3
--	--	---	--	--

All drawings, specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.

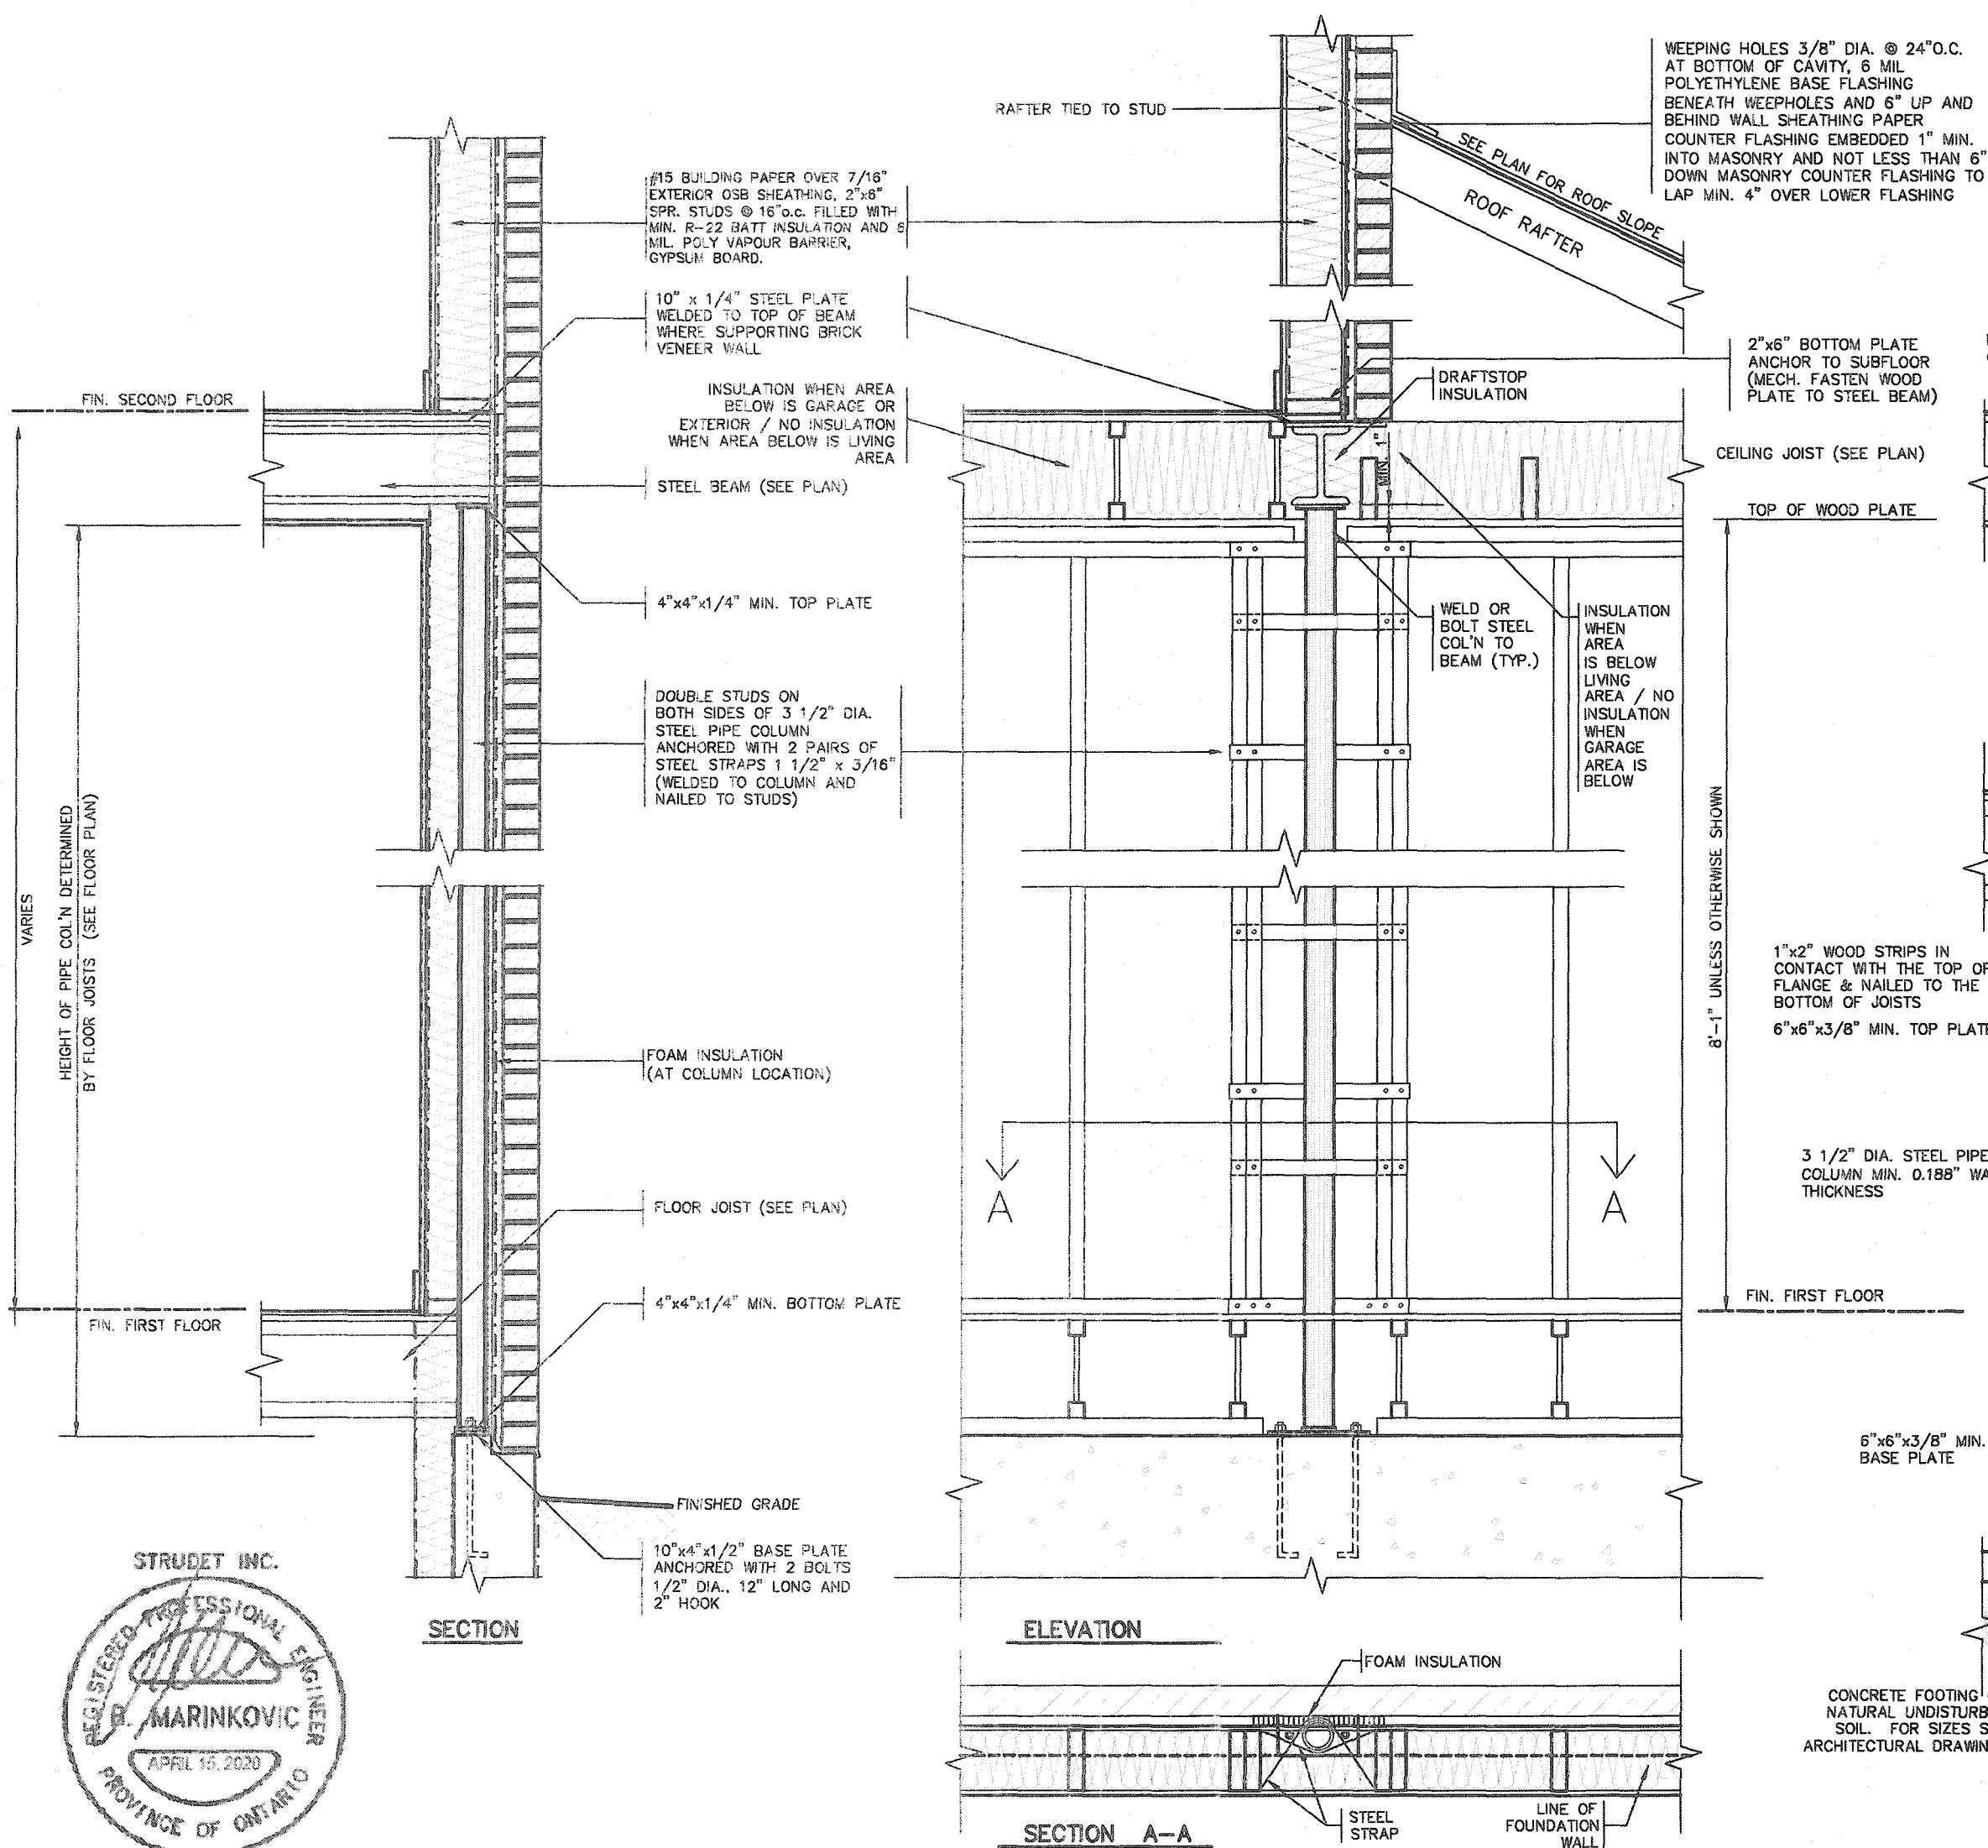


SECTION THROUGH STEEL BEAM SUPPORTING MASONRY & BEARING STUD PARTITION

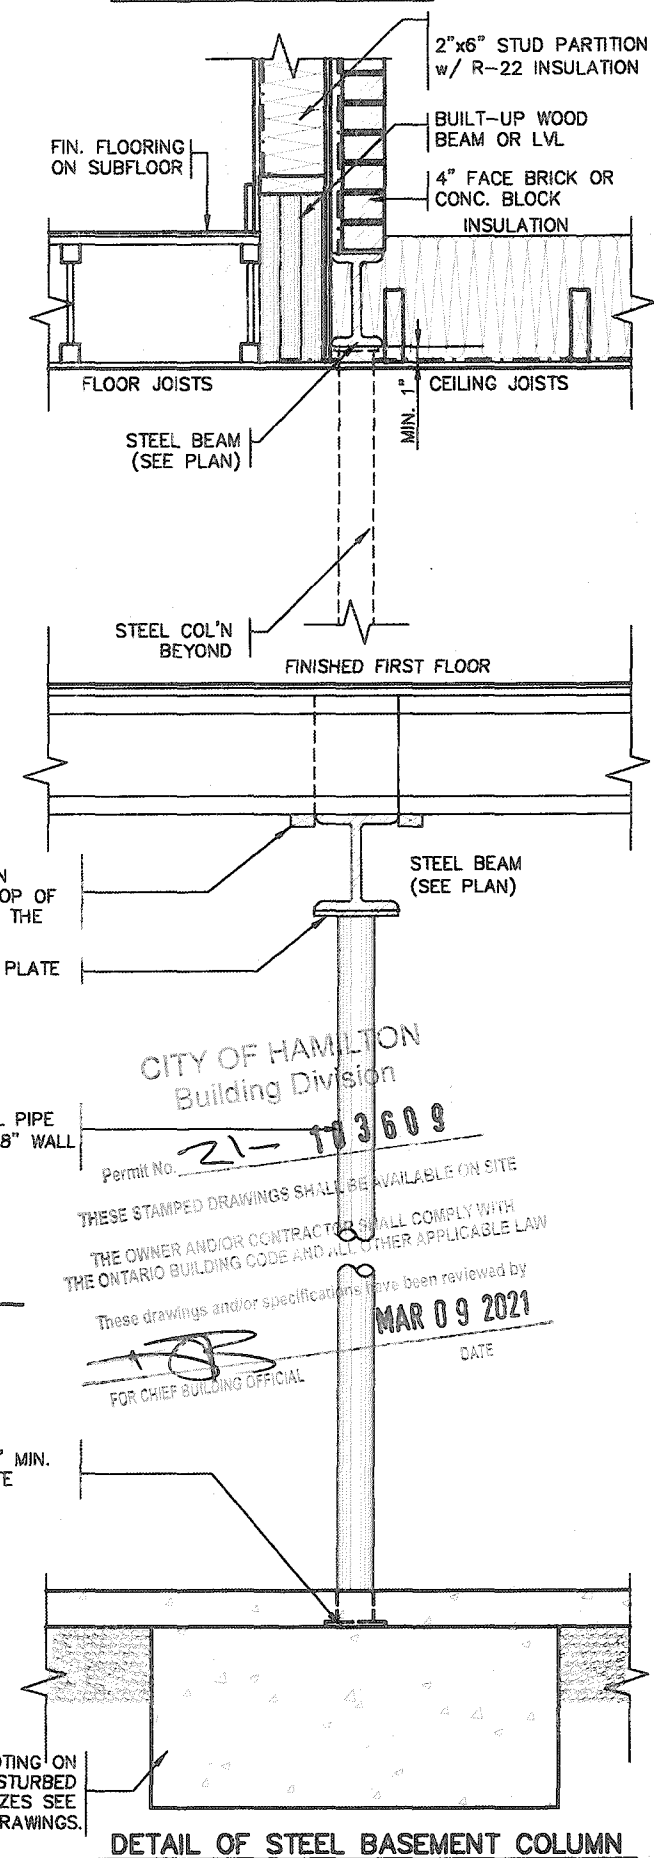


2012 CODE
COMPLIANCE PACKAGE A1




9 8 7 6 5 4 3 2 1 ISSUED FOR PERMIT. no. description	APR 13/20 date by	The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. qualification information Richard Vink signature 24488 BCN 42658 VAS Design Inc. 255 Consumers Rd Suite 120 Toronto, ON M2J 1R4 1 416.630.2255 / 416.630.4782 vasdesign.com	VAS DESIGN Greenpark. SINGLES project name RUSSELL GARDENS PH. 3 location WATERDOWN date APRIL 2020 drawn by GW checked by As Shown project no. 19014 drawing no. 4 18014-GP-STD_DETAILS_A1
---	--	--	--

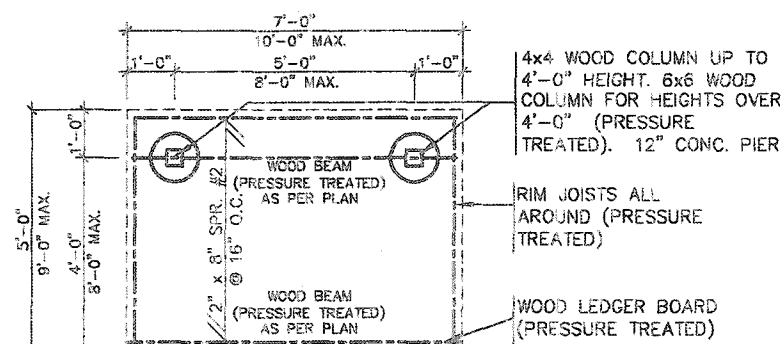


TYPICAL DECK LAYOUT
SCALE: 1/4" = 1'-0"

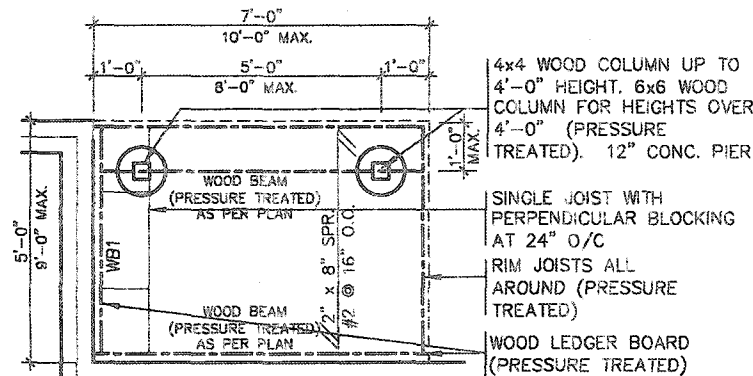


TYPICAL DECK LAYOUT
SCALE: 1/4" = 1'-0"

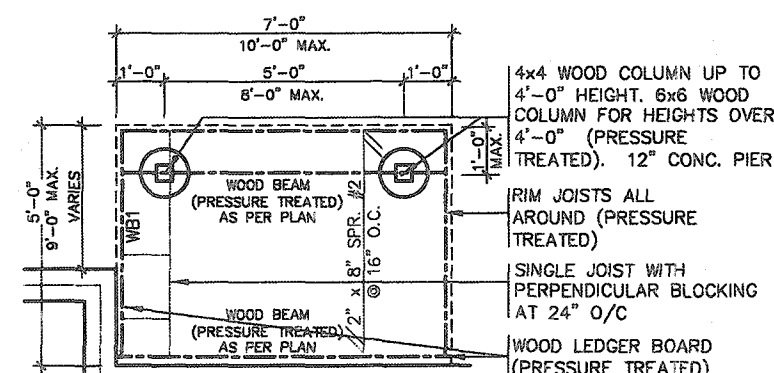

TYPICAL DECK LAYOUT
SCALE: 1/4" = 1'-0"

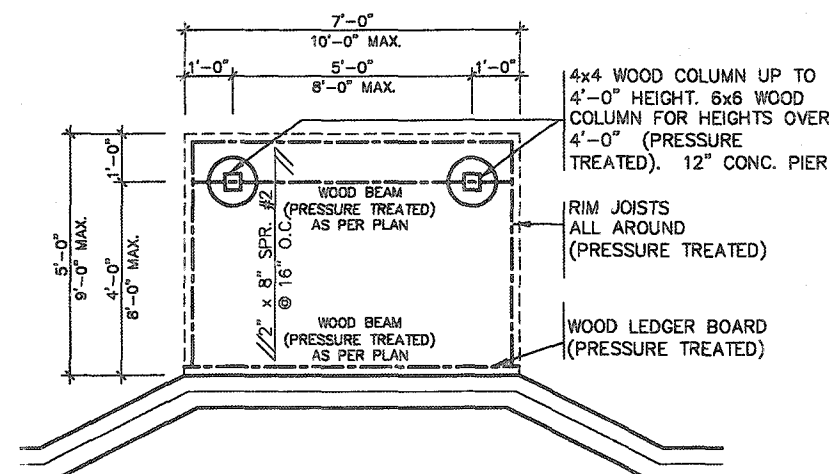




TYPICAL DECK LAYOUT
SCALE: 1/4" = 1'-0"

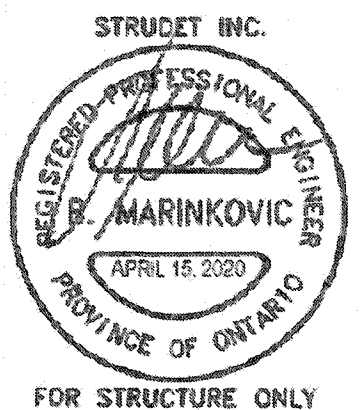

CITY OF HAMILTON
Building Division
Permit No. **21-103609**
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
[Signature] **MAR 09 2021**
DATE
FOR CHIEF BUILDING OFFICIAL


2012 CODE COMPLIANCE PACKAGE A1

1 ISSUED FOR PERMIT APR 13/20 GW	2 CONTRACTOR MUST VERIFY ALL DIMENSIONS ON THE JOB AND REPORT ANY DISCREPANCY TO THE DESIGNER BEFORE PROCEEDING WITH THE WORK. ALL DRAWINGS AND SPECIFICATIONS ARE INSTRUMENTS OF SERVICE AND THE PROPERTY OF THE DESIGNER WHICH MUST BE RETURNED AT THE COMPLETION OF THE WORK. DRAWINGS ARE NOT TO BE SCALED.	VA3 DESIGN 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 v3design.com	Greenpark project name RUSSELL GARDENS PH. 3 WATERDOWN	SINGLES project no. 19014 drawing no.
			date APRIL 2020 drawn by GW	WOOD DECK PLANS 19014-GP-STD_DETAILS_A1 5-1

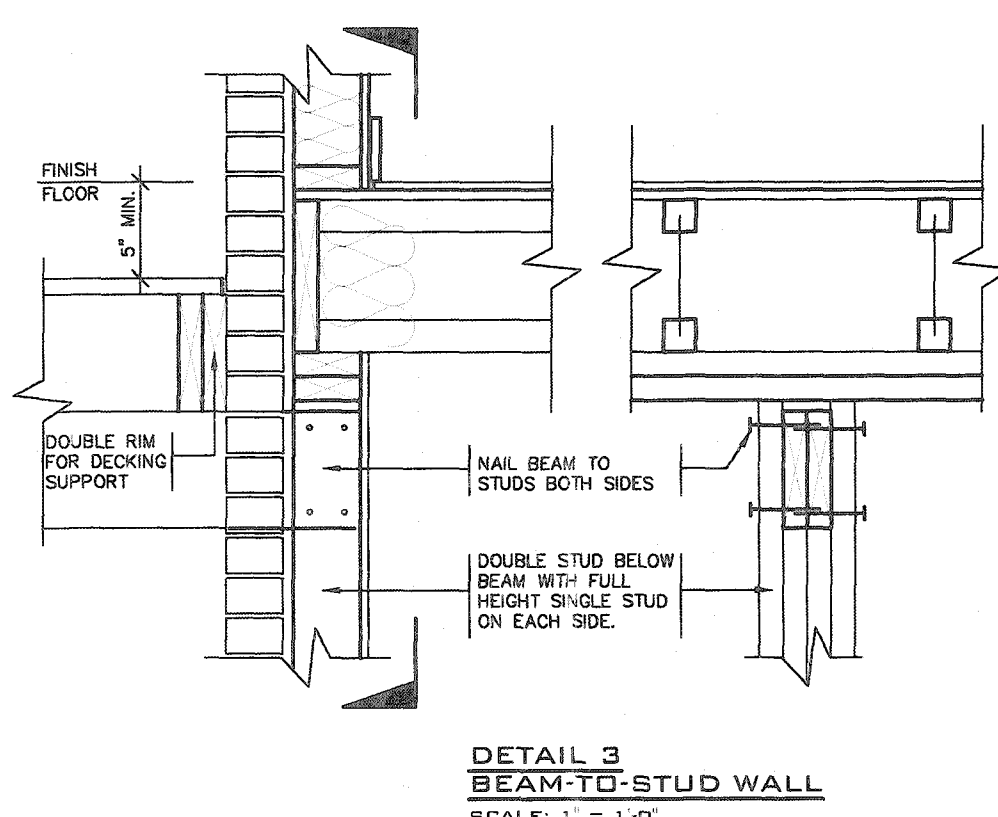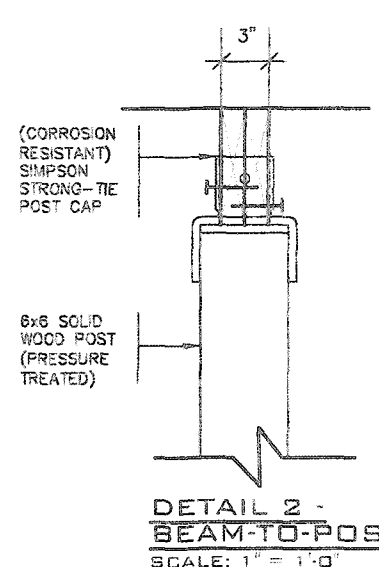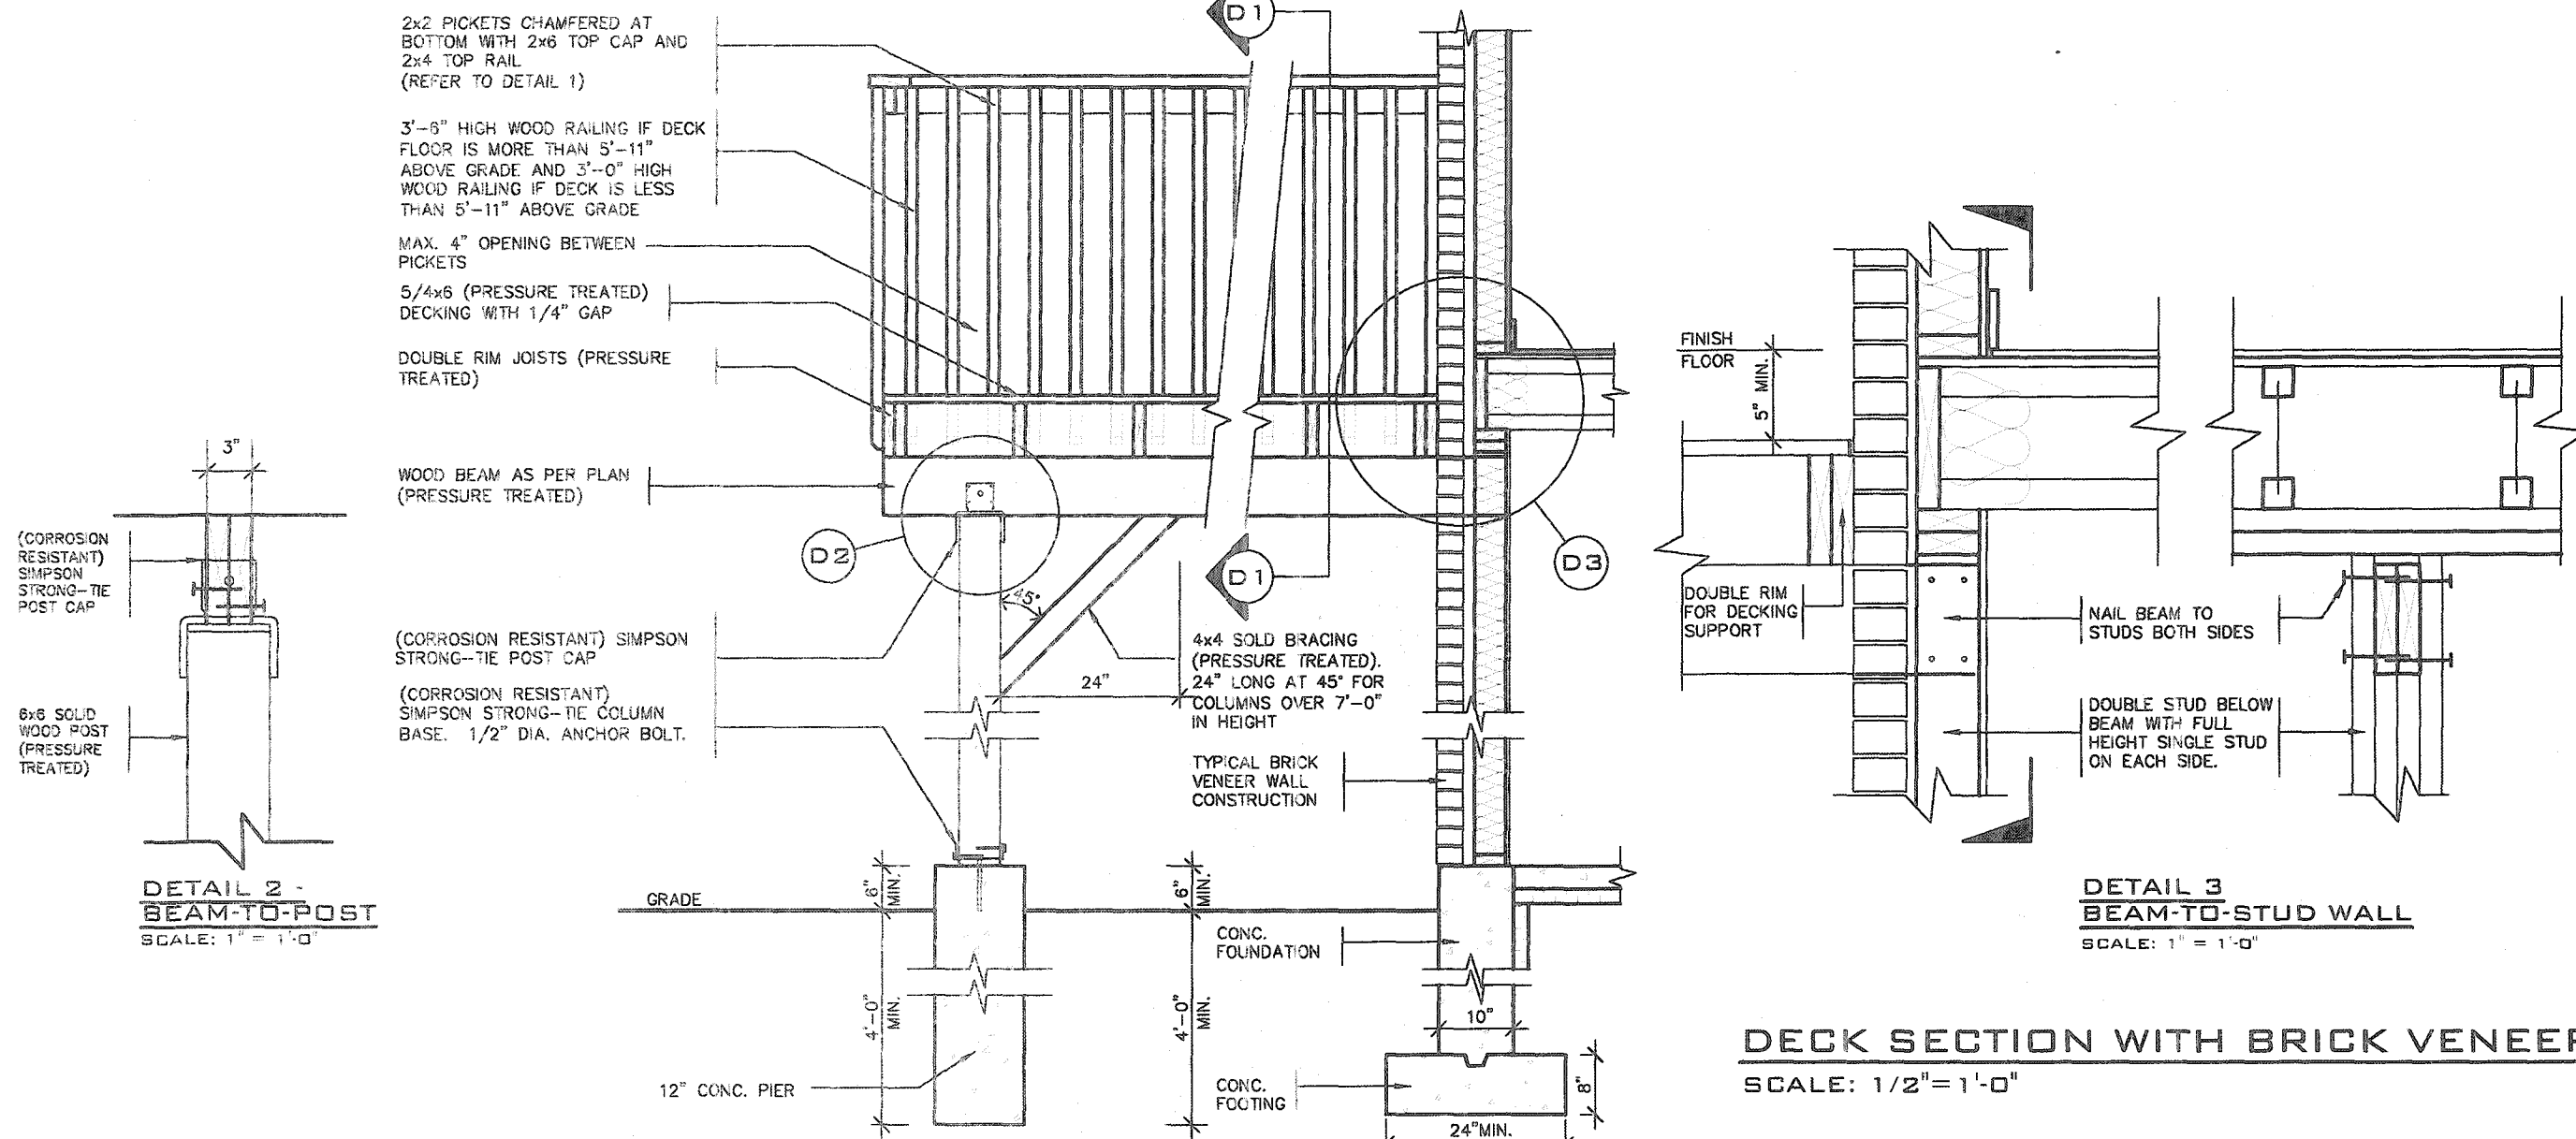


DECK SECTION WITH BRICK VENEER
SCALE: 1/2" = 1'-0"

DETAIL 1
CANTILEVERED PICKET SCREWED TO RIM JOIST AND DECK
GUARD PARALLEL TO FLOOR JOISTS
SCALE: 1" = 1'-0"

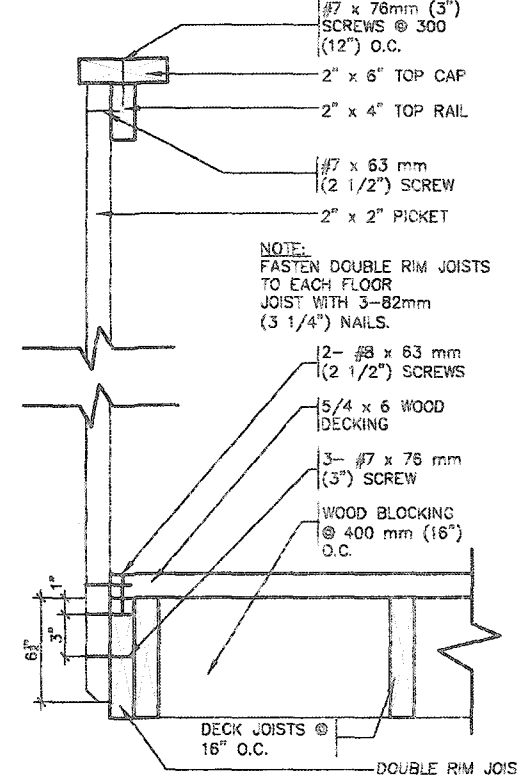


GUARD PERPENDICULAR TO FLOOR JOISTS
SCALE: 1" = 1'-0"

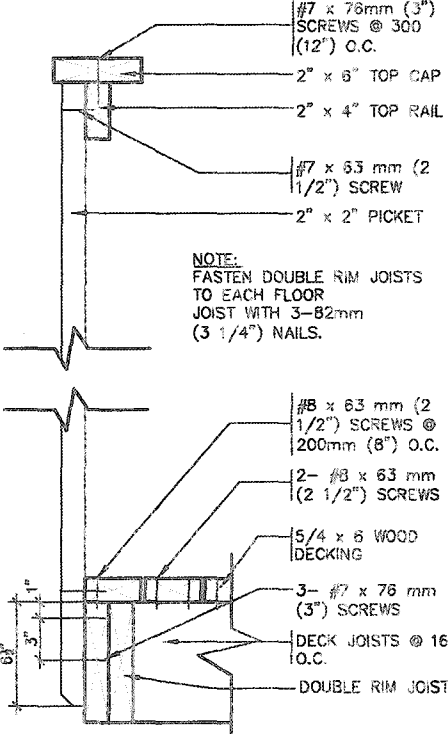

- GENERAL NOTES**
1. BRICK TO HAVE COMPRESSIVE STRENGTH OG 15mPa (2200 p.s.i) MIN. UNITS TO BE LAID WITH FULL HEAD AND BED JOINTS.
 2. MORTAR TO BE TYPE 'S' WITH JOINT THICKNESS OF 10mm (3/8") MIN. AND 20mm (3/4") MAX.
 3. THE DECK HAS BEEN DESIGNED TO SAFELY SUPPORT A SUPERIMPOSED LOAD OF 1.9kPa. [40psf].
 4. ALL NAILS AND SCREWS TO BE GALVANIZED.
 5. WOOD FOR CANTILEVERED PICKETS SHALL BE DOUGLAS FIR-LARCH, SPRUCE-PINE-FIR, OR HEM-FIR SPECIES.
 6. CONCRETE SHALL HAVE COMPRESSIVE STRENGTH OF 20MPa. AT 28 DAYS AND 5-8% AIR ENTRAINED.
 7. FOOTING TO BE PLACED ON UNDISTURBED SOIL WITH MINIMUM BEARING PRESSURE OF 150kPa [3130psf].
 8. WB1= 2- 2"x8" (PRESSURE TREATED)
WB3= 2- 2"x10" (PRESSURE TREATED)


CITY OF HAMILTON
Building Division
Permit No. **21-103609**
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
MAR 09 2021
DATE
FOR CHIEF BUILDING OFFICIAL

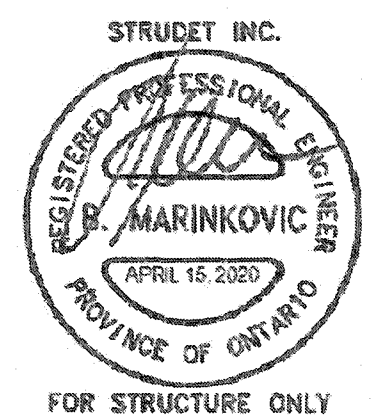


2012 CODE COMPLIANCE PACKAGE A1

1. ISSUED FOR PERMIT. A/R 13/20 GW	The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. qualification information Richard Vink 24488 signature Vink Design Inc. 42659 Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.	VAS DESIGN 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 vasdesign.com	Greenpark. Project name: RUSSELL GARDENS PH. 3 City: WATERDOWN Date: APRIL 2020 Drawn by: GW Checked by: As Shown	SINGLES Project no. 19014 Drawing no. 6 Title: WOOD DECK DETAILS-WALK-OUT CONDITION 19014-GP-STD_DETAILS_A1
---	---	--	--	--


W8
TO
W8
CONNECTION

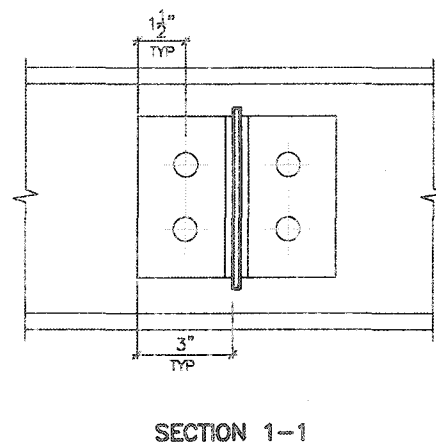


W6(W8)
TO
W10(W12)
CONNECTION

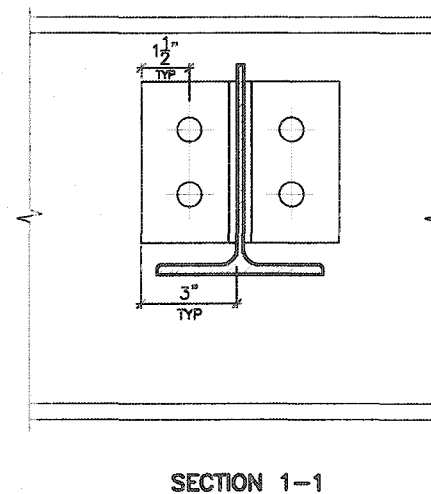


W10
TO
W10
CONNECTION

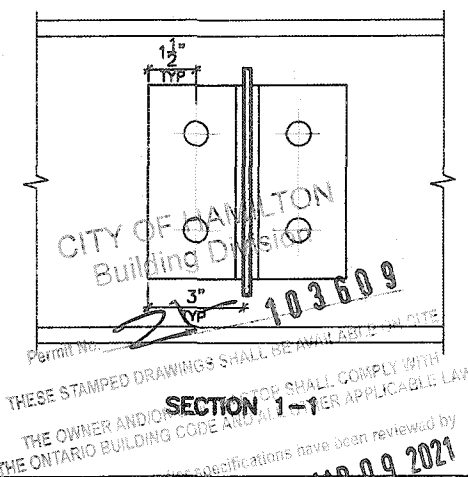


W10
TO
W12
CONNECTION

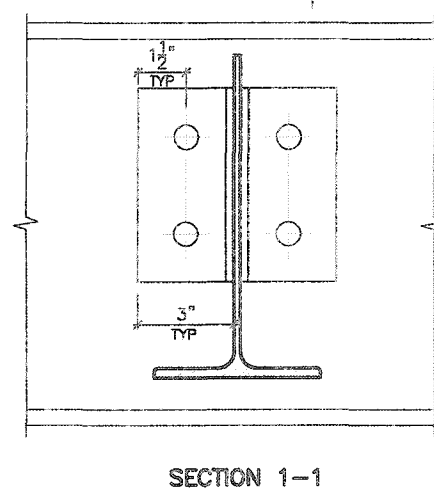


W12
TO
W12
CONNECTION

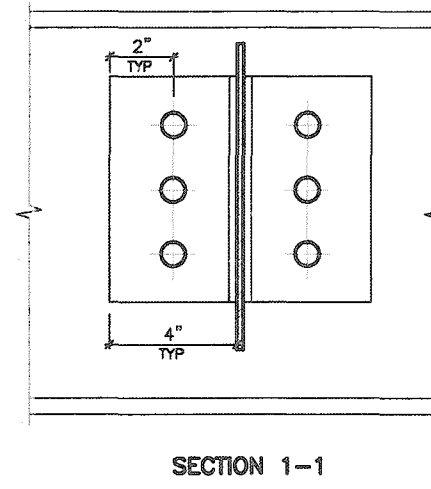

ANGLE TO BEAM CONNECTION

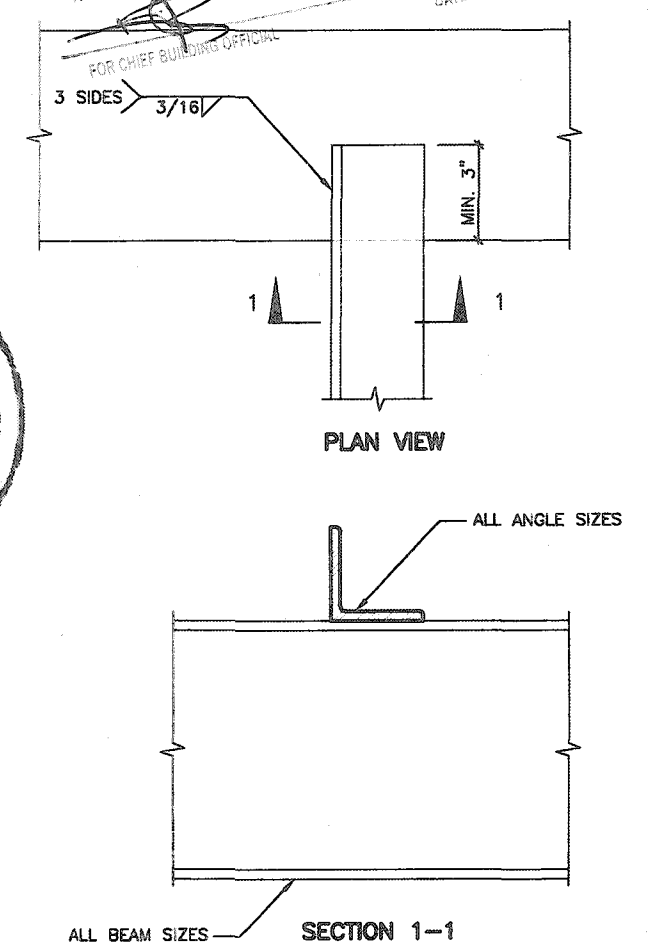

2012 CODE COMPLIANCE PACKAGE

9					The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.
8					
7					qualification information
6					Richard Vink 244B
5					 signature BCI
4					registration information
3					VAS Design Inc. 42655
2					
1	ISSUED FOR PERMIT.	APR 13/20	GW		Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be copied.
no.	description	date	by		





SINGLES

Project no.
9014


no.	
-----	--

All drawings specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.



CITY OF HAMILTON
Building Division
Permit No. 21-103609
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAWS
These drawings and/or specifications have been reviewed by
MAR 09 2021

STRUDET INC

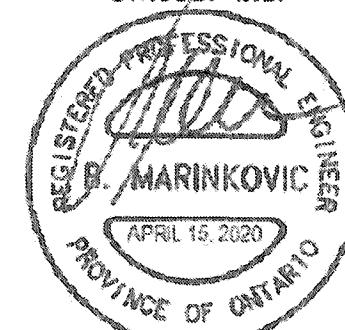

FOR STRUCTURE ONLY

2012 CODE COMPLIANCE PACKAGE

9						The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.
8						
7						qualification information
6						Richard Vink 2441
5						semp signature B
4						registration information
3						VAS Design Inc. 4263
2						
1	ISSUED FOR PERMIT.	APR 13/20	GW			Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be copied.
na.	description	date	by			

**VA3
DESIGN**

255 Consumers Rd Suite 120
Toronto ON M2J 1R4
t 416.630.2255 f 416.630.4782
va3design.com

Greenpark.

project name
RUSSELL GARDENS PH. 3

date

APRIL

GW

DENS PH. 3 WATERDOWN

STUD WALL REINFORCEMENT

WALL REINFORCEMENT

19014-GP-STD_DETAILS_A1

SINGLES

project no.

19014

drawing no.



8

All drawings specifications, related documents and design are the copyright property of V43 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without V43 DESIGN's written permission.



BRICK BEYOND—
CITY OF HAMILTON
CROSS SECTION Building Division

Permit No. 21-103609

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

 FOR CHIEF BUILDING OFFICIAL DATE

STRUDET INC.



FOR STRUCTURE ONLY

2012 CODE COMPLIANCE PACKAGE A1

[illegible]

All drawings, specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.

TYPICAL RIGHT SIDE ELEVATION

TYPICAL BASEMENT PLAN

SLAB ON GRADE CONDITION

NOTES:
1. LEVELS SHOWN ON THE PLANS ARE FOR ILLUSTRATION PURPOSE ONLY, SEE FINAL GRADING PLAN FOR ACTUAL LEVELS
2. ALL LEVELS ARE SHOWN IN METRIC

TYPICAL RIGHT SIDE ELEVATION

TYPICAL BASEMENT PLAN

WALK OUT BASEMENT CONDITION

NOTES:
1. LEVELS SHOWN ON THE PLANS ARE FOR
ILLUSTRATION PURPOSE ONLY, SEE FINAL GRADING PLAN
FOR ACTUAL LEVELS
2. ALL LEVELS ARE SHOWN IN METRIC

SLAB ON GRADE

WALK OUT BASEMENT

OUT BASEMENT 2012 CODE COMPLIANCE PACKAGE

9				The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code as a Designer.	
8				qualification information	
7				Richard Vink	2448
6				<i>R Vink</i>	BCO
5				name	
4				registration information	
3				VAS Design Inc.	4265
2					
1	ISSUED FOR PERMIT.	APR 13/20	GW	Contractor must verify all dimensions on the job end report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be copied.	
	no. description	date	by		


**VA3
DESIGN**
255 Consumers Rd Suite
Toronto ON M2J 1R4
t 416.630.2255 f 416.630
va3design.com


Greenpark.


SINGLES

project name	material	project no.
RUSSELL GARDENS PH. 3	WATERDOWN	19014
date	SLAB ON GRADE INSULATION	
APRIL 2020	drawing no.	
drawn by	checked by	scale
GW	-	Not to Scale
		file name
		19014-GP-STD_DETAILS_A1


All drawings, specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.

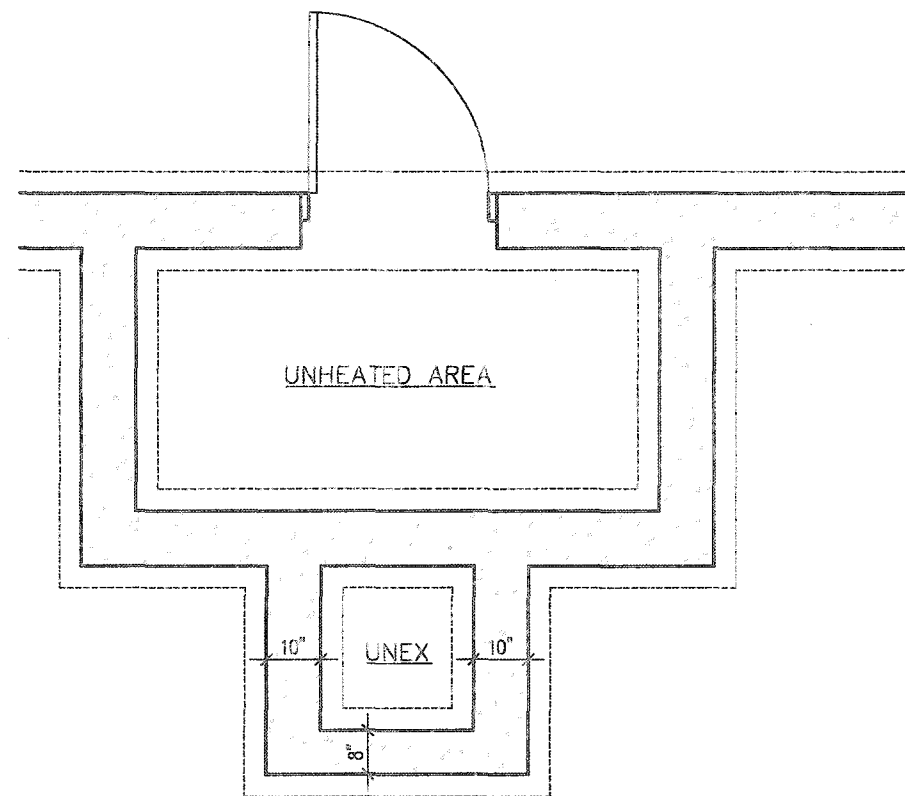

FOUNDATION PLAN

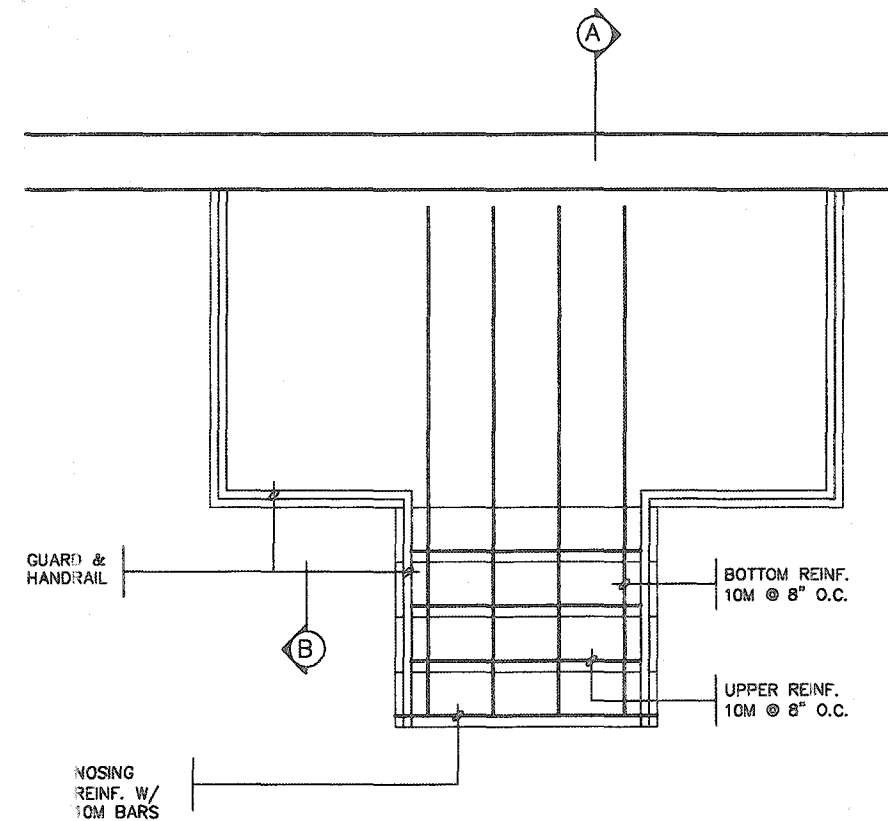

GROUND FLOOR PLAN

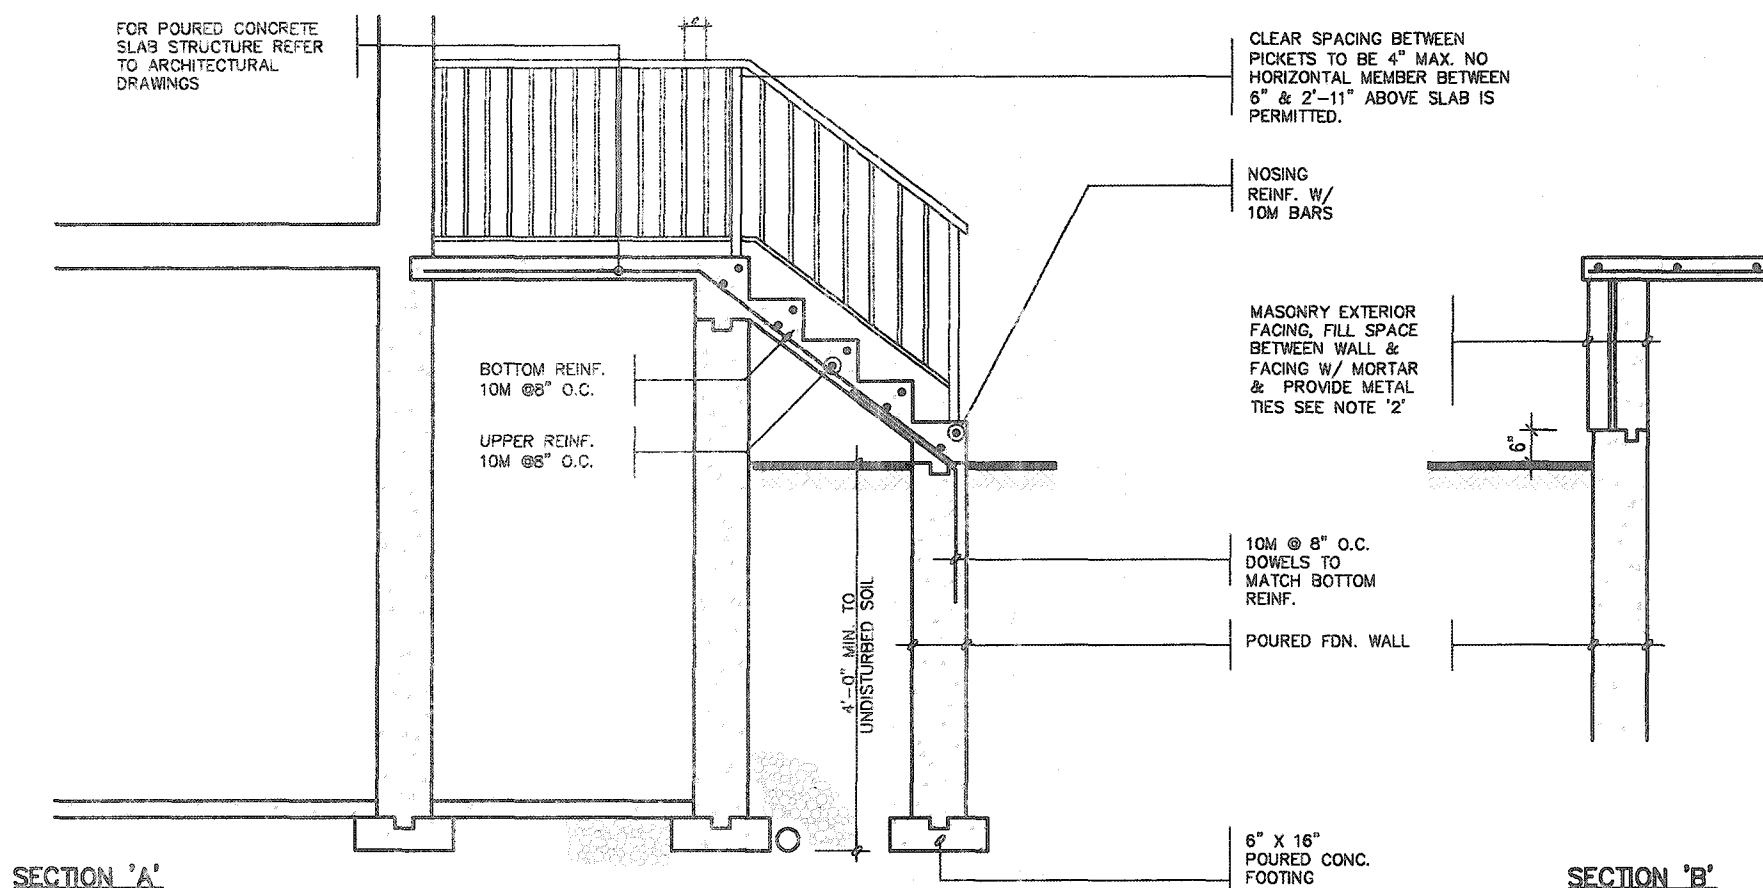

NOTE: FOR MORE THAN 8 RISERS

GENERAL NOTES

- EXTERIOR STAIRS**

7 7/8" RISE MAXIMUM
8 1/4" RUN MINIMUM
9 1/4" TREAD MINIMUM
- MASONRY TIES**

WHEN BRICK FACING IS USED ABOVE GROUND LEVEL, PROVIDE 3/16" DIA. CORROSION RESISTANT METAL TIES @ 36" HORIZONTAL & 8" VERTICAL
- GUARDS**

ARE REQUIRED AROUND CONCRETE SLAB IF MORE THAN 2'-0" ABOVE GRADE & ON BOTH SIDES OF STAIRS CONTAINING MORE THAN 6 RISERS. MINIMUM 34" HIGH FOR STAIRS MINIMUM 36" HIGH FOR PORCHES UP TO 5'-11" ABOVE GRADE. MINIMUM 42" HIGH FOR GREATER HTS.
- HANDRAIL**

ARE REQUIRED WHERE STEPS HAVE MORE THAN 3 RISERS. HANDRAIL HEIGHT 34" - 38"
- FOUNDATION WALLS**


THICKNESS OF FOUNDATION WALLS IS DEPENDANT UPON VENEER CUT 8" FOR UP TO 26" VENEER CUT HEIGHT 10" FOR VENEER CUT OVER 26" HIGH
- CONCRETE**

MINIMUM CONCRETE STRENGTH SHALL BE 4650 PSI [32MPa] W/ 5%-8% AIR ENTRAINMENT MINIMUM CONCRETE SLAB THICKNESS 5"
- CONCRETE COVER**

PROVIDE MINIMUM 3/4" CLEAR CONCRETE COVER TO REINFORCING BARS


CITY OF HAMILTON
Building Division
Permit No. 21-103609

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
FOR CHIEF BUILDING OFFICIAL
DATE MAR 09 2021

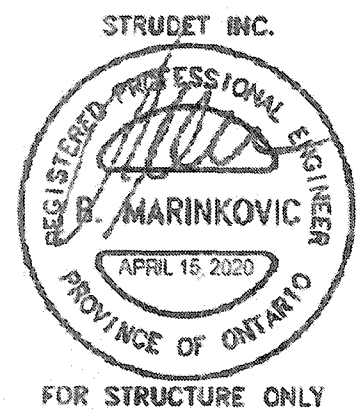


2012 CODE COMPLIANCE PACKAGE A1

9 8 7 6 5 4 3 2 1 ISSUED FOR PERMIT. no. description	APR 13/20 date	by	VA3 DESIGN 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 va3design.com	Greenpark RUSSELL GARDENS PH. 3 WATERDOWN POURED CONC. PORCH STEPS 19014-GP-STD_DETAILS_A1	SINGLES project no. 19014 drawing no. 11
---	------------------------------	-----------	--	---	---

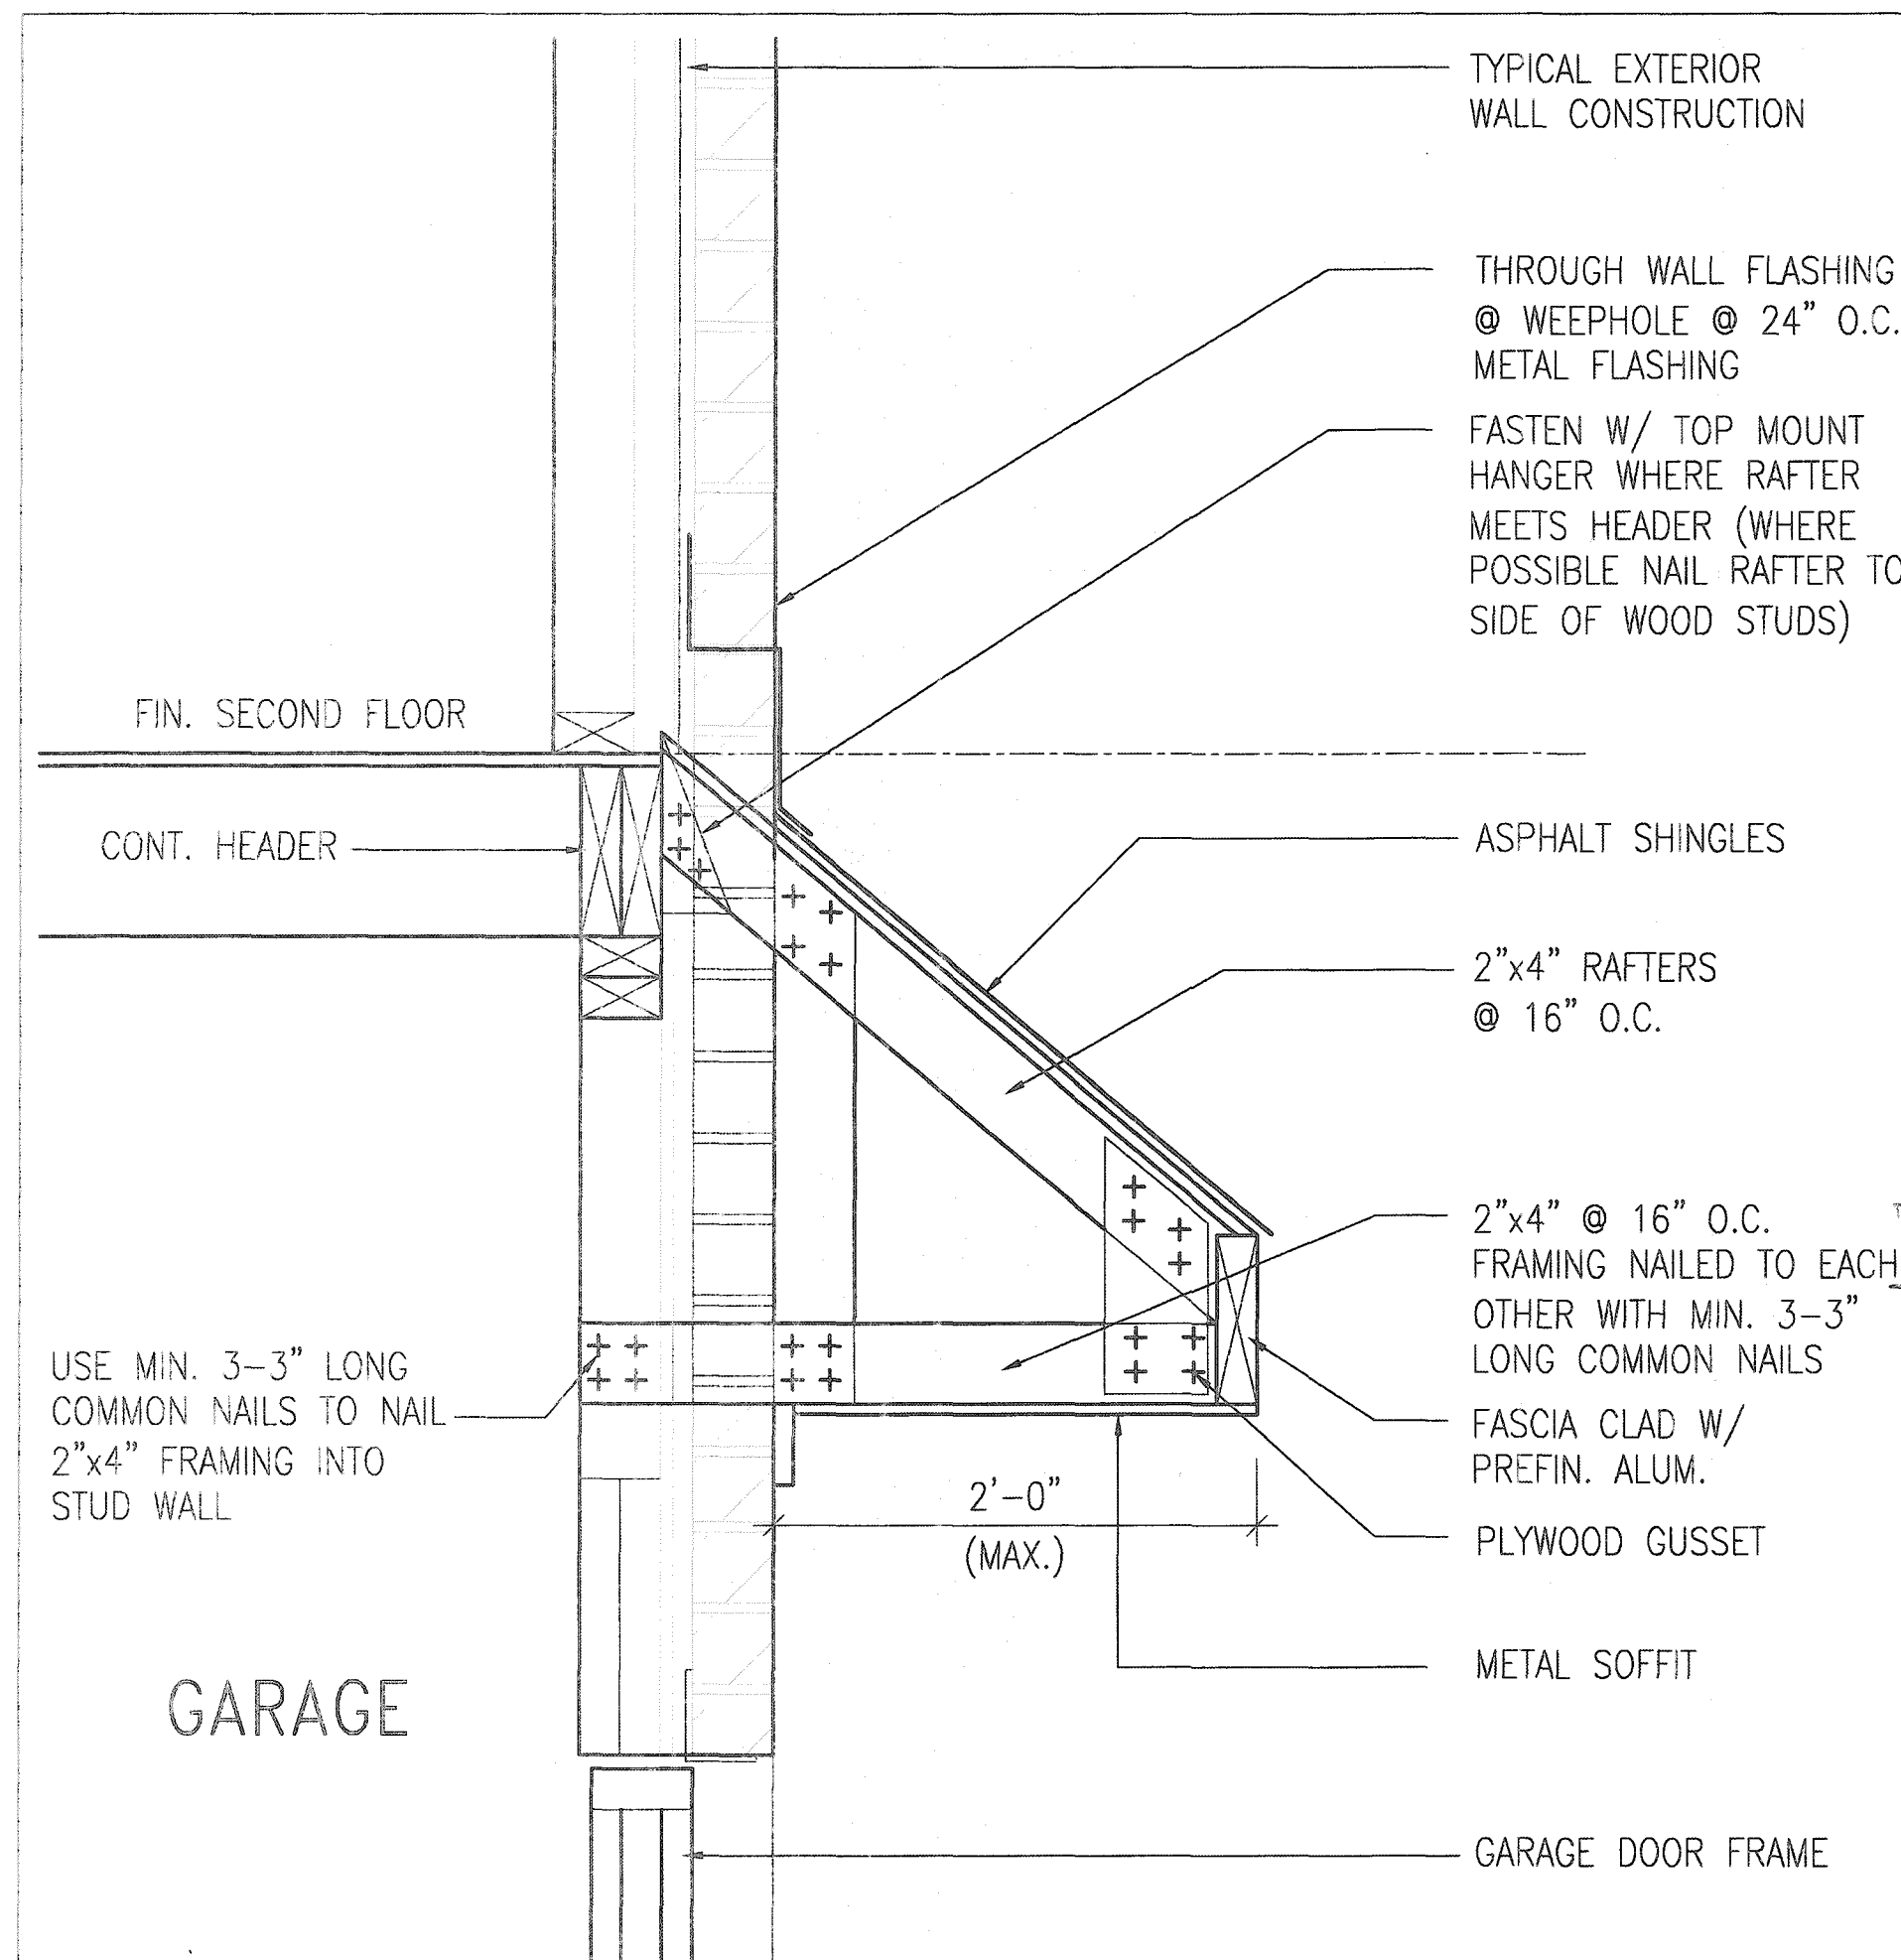

CITY OF HAMILTON
Building Division
Permit No. **21-103609**
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
MAR 09 2021
FOR CHIEF BUILDING OFFICIAL DATE

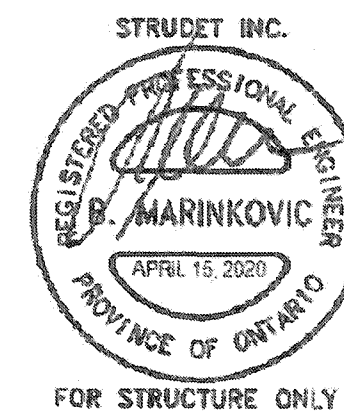

B ROOF OVERHANG DETAIL OVER GARAGE

2012 CODE
COMPLIANCE PACKAGE A1

9. The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. 8. qualification information 7. Richard Vink 24488 BCN 6. name 5. registration information 4. VAS Design Inc. 42658 3. 2. 1. ISSUED FOR PERMIT. APR 13/20 GW NO. description date by		The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. Richard Vink 24488 BCN name registration information VAS Design Inc. 42658 Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be copied.	VA3 DESIGN 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 va3design.com	Greenpark. project name RUSSELL GARDENS PH. 3 date APRIL 2020 drawn by GW checked by Not to Scale scale	municipality WATERDOWN project no. 19014 drawing no. 12	SINGLES DETAIL OF EXTENDED ROOF 19014-GP-STD_DETAILS_A1
---	--	--	---	---	--	---

BRICK/
STONE
VENEER

INVERTED
- 3-1/2"x3-1/2"x1/4"
(90x90x6.0)
STEEL ANGLE

INVERTED
3-1/2"x3-1/2"x1/4"-
(90x90x6.0)
STEEL ANGLE

BRICK/
STONE
VENEER

SUPPORTED STEEL
— ANGLE UP TO 11'-7".
OTHERWISE TO BE
REVIEWED BY ENGINEER.

INVERTED STEEL ANGLE DETAIL

CITY OF HAMILTON
Building Division

Permit No. 21-103609

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

THE ONTARIO BUILDING CODE AND


These drawings and/or specifications have been reviewed by



MAR 09 2021

DATE


FOR CHIEF BUILDING OFFICIAL

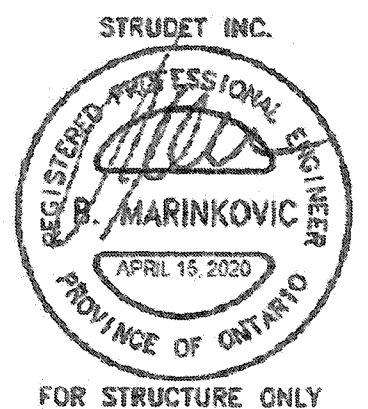


2012 CODE
COMPLIANCE PACKAGE A1

[illegible]

All drawings, specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.

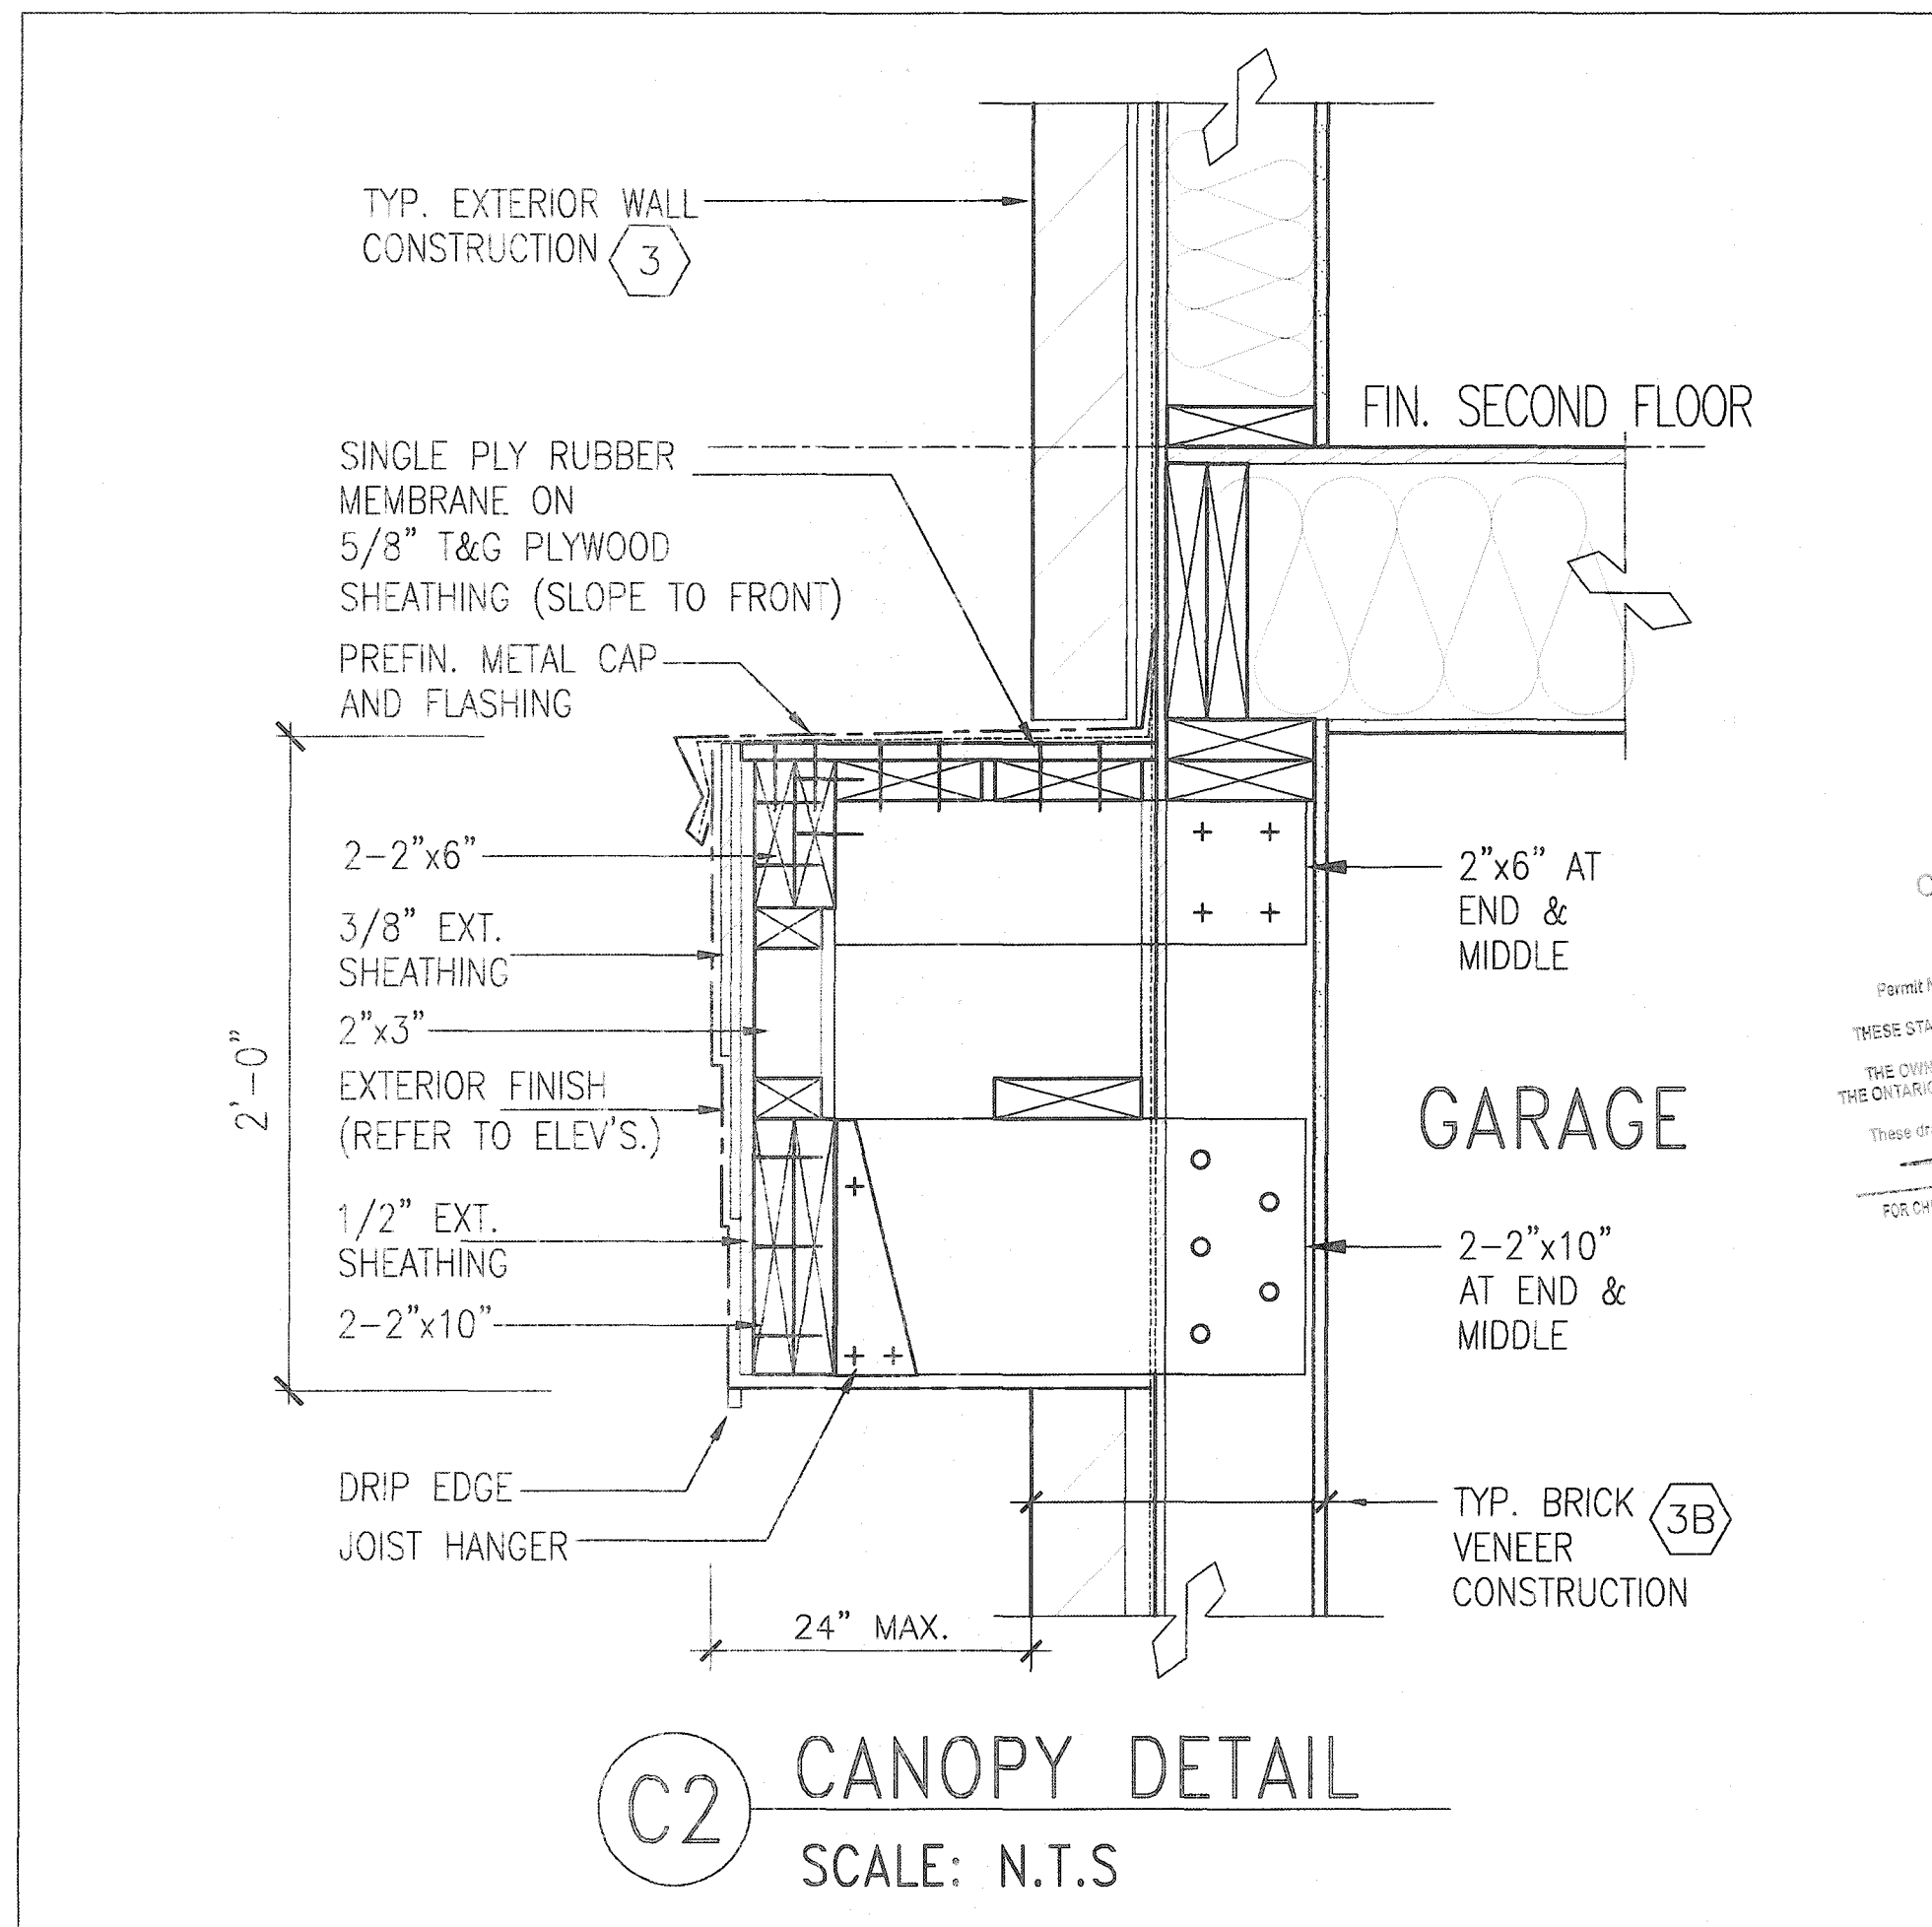

CITY OF HAMILTON
Building Division
Permit No. **21-103609**
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
MAR 09 2021
DATE
FOR CHIEF BUILDING OFFICIAL

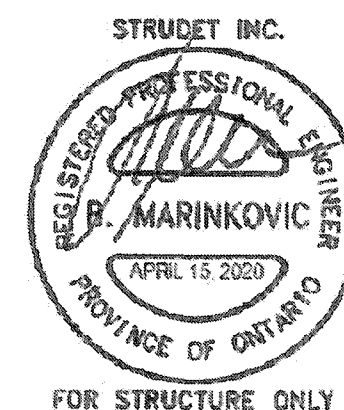

2012 CODE COMPLIANCE PACKAGE A1

9				The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. qualification information Richard Vink 24488 signature <i>R Vink</i> BCN name registration information VAS Design Inc. 42858 Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.	VAS DESIGN 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 vasdesign.com	Greenpark. project name RUSSELL GARDENS PH. 3 city WATERDOWN date APRIL 2020 drawn by GW checked by - scale Not to Scale	SINGLES - project no. 19014 drawing no. 14
8							
7							
6							
5							
4							
3							
2							
1	ISSUED FOR PERMIT.	APR 13/20	GW				
NO.	DESCRIPTION	DATE	BY				