

CONSTRUCTION NOTES (UNLESS OTHERWISE NOTED)
ALL CONSTRUCTION TO ADHERE TO THESE PLANS AND
SPEC'S AND TO CONFORM TO THE ONTARIO BUILDING
CODE AND ALL OTHER APPLICABLE CODES AND
AUTHORITIES HAVING JURISDICTION. THESE REQUIREMENTS
ARE TO BE TAKEN AS MINIMUM SPECIFICATIONS. ONT.
RES. 332/12 - 2012 OBC.

1 ROOF CONSTRUCTION (*SEE OBC 9.19.)
NO. 210 (10.25kg/m²) ASPHALT SHINGLES. 10mm (3/8")
PLYWOOD SHEATHING WITH 1" CLIPS. APPROVED WOOD
TRUSSES @600mm (24") o.c. MAX. APPROVED EAVE
PROTECTION TO EXTEND 900mm (3'-0") FROM EDGE OF
ROOF AND MIN. 300mm (12") BEYOND INNER FACE OF
EXTERIOR WALL. 38x84 (2"x4") TRUSS BRACING @ 1850mm
(6'-0") o.c. AT BOTTOM CHORD. PREFIN. ALUM.
EAVESTROUGH, FASCIA, RAIL & VENTED SOFFIT. PROVIDE
ICE & WATER SHIELD TO ALL ROOF / WALL SURFACES
SUSCEPTIBLE TO DAMPING. ROOF SHEATHING TO BE
FASTENED 150 (6") o.c. ALONG EDGES & INTERMEDIATE
SUPPORTS WHEN TRUSSES SPACED GREATER THAN 406
(16"). ATTIC VENTILATION 1:500 OF INSULATED CEILING
AREA WITH 50% AT EAVES.

2 FRAME WALL CONSTRUCTION (2"x6")
SIDING, HARDIE BOARD, STUCCO BOARD OR EQUAL AS
PER ELEVATION. 1X6 (1"x6") VERTICAL WOOD FURRING,
APPROVED SHEATHING PAPER, 1/16" O.S.B. EXTERIOR
SHEATHING OR OBC COMPLIANT EQUIVALENT. 38x40 (2"x6")
STUDS @ 400mm (16") o.c. W/APPROVED DIAGONAL WALL
BRACING, RSI 3.87 (R22) INSULATION AND APPROVED
VAPOUR BARRIER AND APPROVED CONT. AIR BARRIER,
13mm (1/2") INT. DRYWALL FINISH.

3 BRICK VENEER CONSTRUCTION (2"x6")
90mm (4") FACE BRICK 25mm (1") AIR SPACE,
22x180x16mm (7/8"x1"x0.03") GALV. METAL TIES @
400mm (16") o.c. HORIZONTAL 600mm (24") o.c. VERTICAL.
APPROVED SHEATHING PAPER, 1/16" O.S.B. EXTERIOR
SHEATHING OR OBC COMPLIANT EQUIVALENT. 38x40 (2"x6")
STUDS @ 400mm (16") o.c. W/APPROVED DIAGONAL WALL
BRACING, RSI 3.87 (R22) INSUL. APPROVED VAPOUR
BARRIER AND APPROVED CONT. AIR BARRIER, 13mm (1/2")
INT. DRYWALL FINISH. PROVIDE WEEP HOLES @ 800mm
(32") o.c. BOTTOM COURSE AND OVER OPENINGS.
PROVIDE BASE
FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER.

3A STUCCO WALL CONSTRUCTION (2"x6")
STUCCO CLADDING SYSTEM CONFORMING TO OBC 9.27.11.2)
& 9.28 THAT EMPLOY A MINIMUM 6mm (1/4") DRAINAGE
CAVITY BEHIND THE CLADDING WITH POSITIVE DRAINAGE
TO THE EXTERIOR AND APPLIED AS PER MANUFACTURERS
SPECIFICATION ON 25mm (1") MINIMUM EXTRUDED OR
EXPANDED RIGID INSULATION, APPROVED SHEATHING
PAPER, 1/16" O.S.B. EXTERIOR SHEATHING OR OBC
COMPLIANT EQUIVALENT. 38x40 (2"x6") STUDS @ 400mm
(16") o.c. W/APPROVED DIAGONAL WALL BRACING, RSI
3.87 (R22) INSUL. APPROVED VAPOUR BARRIER AND
APPROVED CONT. AIR BARRIER, 13mm (1/2") INT. DRYWALL
FINISH. STUCCO TO BE MIN. 200mm (8") ABOVE FINISH
GRADE.

4 INTERIOR STUD PARTITIONS
(*SEE OBC 9.23.10.6.9.23.11.)
BEARING PARTITION 38x84 (2"x4") @ 400mm (16") o.c.
FOR 2 STOREYS AND 300mm (12") o.c. FOR 3 STOREYS.
NON-BEARING PARTITIONS 38x84 (2"x4") @ 600mm (24")
o.c. PROVIDE 38x84 (2"x4") BOTTOM PLATE AND
28x84 (2"x4") TOP PLATE. 15mm (1/2") INTERIOR
DRYWALL BOTH SIDES OF STUD. PROVIDE 38x40 (2"x6")
STUDS/PLATES WHERE NOTED.

5 FOUNDATION WALL/FOOTINGS:
(*SEE OBC 9.15.3 & 9.15.4.)
MIN. 200mm (8") POURED CONC. FDN. WALL 15MPa
(2200psi) WITH SIMULTANEOUS DAMPROOFING AND
DRAINAGE LAYER. MIN. 420x95 (16"x6") CONTIN. KEYED
CONC. PTS. BRACE FOUNDATION WALL PRIOR TO
BACKFILLING. ALL FOOTINGS SHALL REST ON NATURAL
UNDISTURBED SOIL WITH MINIMUM BEARING CAPACITY OF
120kPa (11.4 psi) OR GREATER.

6 WEEPING TILE (*SEE OBC 9.14.8.)
100mm (4") DIA. WEEPING TILE 150mm (6") CRUSHED STONE
OVER AND AROUND WEEPING TILES.

7 BASEMENT SLAB (*SEE OBC 9.16.1)
60mm (2") MIN. 25MPa (3600psi) CONC. SLAB ON 100mm
(4") COARSE GRANULAR FILL, OR 15MPa (2200psi) CONC.
WITH DAMPROOFING BELOW SLAB.

8 WOOD SUBFLOORS (*SEE OBC 9.23.14. & 9.30.2.)
19mm (3/4") T&G SUBFLOOR UNDER GROUND FLOOR FINISH
FLOOR. 19mm (3/8") T&G SUBFLOOR UNDER SECOND
FLOOR FINISH FLOOR. 19mm (3/8") PANEL-TYPE
UNDERLAY FOR CERAMIC TILE APPLICATION. 6mm (1/4")
PANEL-TYPE UNDERLAY UNDER RESILIENT & PARQUET
FLOORING.

9 ROOF INSULATION (*SEE 9.12 - 2.1.1.2.A & 2.1.1.7)
RSI 10.57 (R50) ROOF INSULATION AND APPROVED
VAPOUR BARRIER, 15mm (5/8") INT. DRYWALL FINISH OR
APPROVED EQUAL.

10 ALL STAIRS/EXTERIOR STAIRS (*SEE OBC 9.8.1)
MAX. RISE = 200 (7'-10")
MIN. RUN = 210 (6'-10")
MIN. TREAD = 255 (8'-4")
MAX. NOSING = 25 (1")
MIN. HEADROOM = 1950 (6'-5")
RAIL @ LANDING = 400 (2'-0")
RAIL @ STAIR = 365 (2'-10") TO 465 (5'-2")
MIN. STAIR WIDTH = 860 (2'-9")

FOR CURVED STAIRS
MIN. AVG. RUN = 200 (6")
MIN. RUN = 150 (5")

11 RAILING (*SEE OBC 9.8.8.)
FINISHED RAILING ON PICKETS SPACED MAXIMUM 100mm
(4") BETWEEN PICKETS.

INTERIOR GUARDS = 900mm (2'-11") MIN.
EXTERIOR GUARDS = 1070mm (3'-6") MIN.

12 SILL PLATE (*SEE OBC 9.23.6 & 9.23.7.)
38x84 (2"x4") SILL PLATE WITH 15mm (1/2") DIA. ANCHOR
BOLTS 200mm (8") LONG, EMBEDDED MIN. 100mm (4") INTO
CONC. @ 2400mm (7'-10") o.c. CAULKING OR 25 (1") MIN.
MINERAL WOOL BETWEEN PLATE AND TOP OF FDN. WALL.
USE MORTAR TO LEVEL SILL PLATE WHEN REQUIRED.

13 BASEMENT INSULATION (*SEE OBC 12.3.)
FOUNDATION WALLS ENCLOSING HEATED SPACE SHALL BE
INSULATED FROM THE UNDERSIDE OF THE SHEET PILE OR TO
NOT MORE THAN 152mm (6") ABOVE THE FINISHED FLOOR
OF THE BASEMENT AND NOT LESS THAN 50mm (2") TO THE
SLAB.
FOUNDATION WALL INSULATION SHALL BE MINIMUM RSI
3.52 (R20) BLANKET INSULATION APPROVED VAPOUR
BARRIER, DAMPROOFING WELDS. PAPER BETWEEN THE
FDN. AND INSUL.

14 BASEMENT BEARING STUD PARTITION
(*SEE OBC 9.23.10.)
38x84 (2"x4") STUDS @ 400mm (16") o.c. 38x84 (2"x4") SILL
PLATE ON DAMPROOFING MATERIAL, 15mm (1/2") DIA.
ANCHOR BOLTS 200mm (8") LONG, EMBEDDED MIN. 100mm
(4") INTO CONC. @ 2400mm (7'-10") o.c. (4") HIGH CONC.
CURB ON 305x155 (12"x6") CONC. FOOTING. ADD HORIZ.
BLOCKING AT MID-HEIGHT IF WALL IS UNFINISHED.

15 STEEL BASEMENT COLUMN (*SEE OBC 9.17.3.)
90mm (3-1/2") DIA. x 4.75mm (186) STL. COL. WITH
150x150x4.5mm (6"x6"x3/8") STL. TOP & BOTTOM PLATE.

15A STEEL COLUMN (*SEE OBC 9.17.3.)
90mm (3-1/2") DIA. x 4.75mm (186) STL. COLUMN WITH
100x100x6.4mm (4"x4"x1/4") STEEL TOP & BOTTOM PLATE.
FIELD WELD BOTTOM PLATE TO 250x100x12.5mm
(10"x4"x1/2") BASE PLATE CAN 2-15mm (1/2") DIA. x 500mm
(12") LONG x 50mm (2") HOOK ANCHORS.

16 NIB WALLS (*SEE OBC 9.23.8.)
BEAM POCKET OR 200x200 (8"x8") POURED CONCRETE
NIB WALLS. MINIMUM BEARING 90mm (3-1/2")

17 STEEL BEAM STRAPPING (*SEE OBC 9.23.4.3.(3)(d))
19x38 (1"x2") CONTINUOUS WOOD STRAPPING BOTH SIDES
OF STEEL BEAM.

18 GARAGE SLAB (*SEE OBC 9.16.1)
100mm (4") 32MPa (4640psi) CONC. SLAB WITH 5-8% AIR
ENTRAINMENT ON OPT. 100 (4") COARSE GRANULAR FILL
WITH COMPACTED SUB-BASE OR COMPACTED NATIVE
FILL. SLOPE TO FRONT 1% MIN.

19 INTERIOR GARAGE WALLS & CEILING
(*SEE OBC 9.10.9.16.)
15mm (1/2") GYPSUM BOARD ON WALL AND CEILING
BETWEEN HOUSE AND GARAGE, RSI 3.87 (R22) IN WALLS,
RSI 5.46 (R30) IN CEILING. TAPE AND SEAL ALL JOINTS
GAS TIGHT.

20 GARAGE DOOR GASPROOFING
(*SEE OBC 9.10.13.15.)
DOOR AND FRAME GASPROOFING. DOOR EQUIPPED WITH
SELF CLOSING DEVICE AND WEATHER STRIPPING.

21 EXTERIOR STEP
(*SEE OBC 9.8.9.2, 9.8.9.3 & 9.8.10.)
PRECAST CONCRETE STEP OR IND. STEP WHERE NOT
EXPOSED TO WEATHER MAX. RISE 200mm (7'-10").
MINIMUM TREAD 280mm (9'-1/2")

22 DRYER VENT (*SEE OBC 6.2.3.5.(7))
CAPTED DRYER EXHAUST VENTED TO EXTERIOR. USE
1000mm (4") DIA. SMOOTH WALL VENT PIPE.

23 ATTIC ACCESS (*SEE OBC 9.19.2.)
ATTIC ACCESS HATCH 645x100 (2'2"x28") WITH
WEATHERSTRIPPING. RSI 5.46 (R30) RIGID INSULATION
BACKING.

24 FIREPLACE CHIMNEYS (*OBC 9.21.1)
TOP OF FIREPLACE CHIMNEY SHALL BE 95mm (3'-0")
ABOVE THE HIGHEST POINT AT WHICH IT COMES IN
CONTACT WITH THE ROOF AND 610mm (2'-0") ABOVE THE
ROOF SURFACE WITHIN A HORIZ. DISTANCE OF 3050mm
(10'-0") FROM THE CHIMNEY.

25 LINEN CLOSET
4 SHELVES MIN. 380mm (14") DEEP.

26 MECHANICAL EXHAUST
(*SEE OBC 9.32.3.5, 9.32.3.10.)
MECHANICAL EXHAUST FAN VENTED TO EXTERIOR.

27 STEEL BEARING PLATE FOR MASONRY WALLS
280x280x16 (11"x11"x5/8") STL. PLATE FOR STL. BEAMS
AND 280x280x12 (11"x11"x1/2") STL. PLATE FOR WOOD
BEAMS BEARING ON CONC. BLOCK PARTYWALL,
ANCHORED W/ 2-19mm (3/4") x 200mm (8") LONG GALV.
ANCHORS WITHIN SOLID BLOCK COURSE. LEVEL WITH
NON-SHRINK GROUT.

28 GLASS "B" VENT
ULC. RATED GLASS "B" VENT 610mm (2'-0") ABOVE THE
POINT IN CONTACT WITH THE ROOF FOR SLOPES UP TO
9/12, REFER TO THE ONTARIO GAS UTILIZATION CODE.

29 WOOD BASEMENT POST (*OBC 9.17.4.)
5-38x40 (2"x6") BUILT-UP POST ON METAL BASE SHOE
ANCHORED TO CONC. WITH 12.7 (1/2") DIA. BOLT ON
406x406x203 (16"x16"x8") CONC. FOOTING.

30 STEP FOOTINGS (*OBC 9.15.3.9.)
MIN. HORIZ. STEP = 610mm (24") MAX. VERT. STEP =
610mm (24")

31 SLAB ON GRADE (*SEE OBC 9.16.1)
100mm (4") 32MPa (4640psi) CONC. SLAB WITH 5-8% AIR
ENTRAINMENT ON OPT. 100 (4") COARSE GRANULAR FILL
WITH COMPACTED SUB-BASE OR COMPACTED NATIVE
FILL REINFORCED W/ 6x6-M2.9xM2.9 MESH PLACED NEAR
MID-DEPTH OF SLAB.

32 DIRECT VENT FURNACE
DIRECT VENT FURNACE TERMINAL MIN. 900mm (36") FROM
A GAS REGULATOR, MIN 300mm (12") ABOVE FIN. GRADE,
FROM ALL OPENINGS, EXHAUST & INTAKE VENTS. HRV
INTAKE TO BE A MIN. OF 1850mm (6'-0") FROM ALL
EXHAUST TERMINALS. REFER TO GAS UTILIZATION CODE.
ALL AIR INTAKES SHALL BE LOCATED SO THAT THEY
ARE SEPARATED FROM KITCHEN EXHAUST BY 3.0m IN
COMPLIANCE WITH O.B.C. DIV.-B TABLE 6.2.9.12.

33 DIRECT VENT GAS FIREPLACE
DIRECT VENT GAS FIREPLACE VENT TO BE A MINIMUM
300mm (12") FROM ANY OPENING AND ABOVE FIN. GRADE.
REFER TO GAS UTILIZATION CODE

34 JOIST STRAPPING & BRIDGING (*SEE OBC 23.9.4.)
ALL FLOOR JOISTS TO BE BRIDGED WITH 38x38 (2"x2")
CROSS BRACING OR SOLID BLOCKING @ 2100mm (6'-11")
o.c. MAX. 19x64 (1"x5") @ 2100mm (6'-11") o.c. UNLESS A
PANEL TYPE CEILING FINISH IS APPLIED.

35 EXPOSED BUILDING FACE (*SEE OBC 9.10.15.)
EXTERIOR WALLS TO HAVE A FIRE RESISTANCE RATING
OF NOT LESS THAN 45min. WHERE LIMITING DISTANCE IS
LESS THAN 1.2m (3'-11") WHERE THE LIMITING DISTANCE IS
LESS THAN 600mm (1'-11") THE EXPOSING FACE SHALL BE
CLAD IN NON-COMBUSTIBLE MATERIAL.

36 COLD CELLAR PORCH SLAB (*SEE OBC 9.40.)
FOR MAX. 2500mm (8'-2") PORCH DEPTH, 125mm (5") 32MPa
(4640 psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT.
REINF. WITH 10M BARS @ 200mm (8") o.c. EACH WAY IN
BOTTOM THIRD OF SLAB, ANCHORED IN PERIMETER FDN.
WALLS W/ 610x610 (24"x24") 10M @ 600mm (24") o.c.
DOWELS. SLOPE SLAB MIN. 1.0% FROM DOOR. SLAB TO
HAVE A MIN. 75mm (3") BEARING ON FDN. WALLS.
PROVIDE (AL) LINTELS OVER CELLAR DOOR.

37 FDN. WALL REDUCTION IN THICKNESS
(*SEE OBC 9.15.4.7.)
FDN. WALL SHALL NOT BE REDUCED TO LESS THAN 90mm
(3-1/2") THICK TO A MAX. DEPTH OF 660mm (2'-0") FOR 8"
FDN. WALL. 10" FDN. WALL WHEN REDUCTION IN
THICKNESS IS GREATER THAN 20". FDN. WALL SHALL BE
TIED TO THE FACING MATERIAL WITH METAL TIES SPACED
200mm (8") o.c. VERTICALLY AND 400mm (16") o.c.
HORIZONTALLY. FILL SPACE BETWEEN WALL AND FACING
SOLID WITH MORTAR.

38 CONVENTIONAL ROOF FRAMING
(*SEE OBC 9.23.4.2.11)
FOR MAX. 2240mm (7'-4") SPAN, 38x84 (2"x4") RAFTERS
@ 400mm (16") o.c. FOR MAX. 5590mm (11'-1") SPAN,
38x40 (2"x6") RAFTERS @ 400mm (16") o.c. RIDGE
BOARD TO BE 51mm (2") DEEPER. 38x84 (2"x4") COLLAR
TIES AT MIDSPAN. CEILING JOISTS TO BE 38x84 (2"x4")
@ 400mm (16") o.c. FOR MAX. 2830mm (9'-3") SPAN &
38x40 (2"x6") @ 400 (16") o.c. FOR MAX. 4450mm (14'-7")
SPAN. RAFTERS FOR BUILT-UP ROOF TO BE 38x84 (2"x4")
@ 600mm (24") o.c. WITH A 38x84 (2"x4") CENTER POST TO
THE TRUSS BELOW, LATERALLY BRACED @ 1800mm (6'-0")
o.c. VERTICALLY.

39 TWO STOREY VOLUME SPACES
FOR A MAXIMUM 5440mm (18'-0") HEIGHT, PROVIDE
2-38x40 (2"x6") CONTINUOUS STUDS @ 300mm (12") o.c.
FOR BRICK AND 400mm (16") o.c. FOR SIDING. PROVIDE
SOLID WOOD BLOCKING BETWEEN STUDS @ 1220mm (4'-0")
o.c. VERT. 1/16" EXT. PLYWOOD.

40 EXPOSED FLOOR TO EXTERIOR (*9.12 - 2.1.1.2.A)
PROVIDE RSI 5.46 (R30) INSULATION, APPROVED VAPOUR
BARRIER AND CONTINUOUS AIR BARRIER, FINISHED
SOFFIT.

41 PARTYWALLS
TYPICAL 1 HOUR RATED PARTYWALL. REFER TO DETAILS
FOR TYPE AND SPECIFICATIONS.

42 EXTERIOR WALLS FOR WALK-OUT CONDITION
THE EXTERIOR BASEMENT STUD WALL TO BE 38x40mm
(2"x6") STUDS @ 400mm (16") o.c. MATCH FLOOR JOIST
SPACING WHEN PARALLEL WITH FLOOR JOISTS.

43 SMOKE ALARM (*OBC 9.10.19)
PROVIDE 1 PER FLOOR, NEAR THE STAIRS CONNECTING THE
FLOOR LEVEL AND ALSO 1 IN EACH BEDROOM NEAR HALL
DOOR. ALARMS TO BE CONNECTED TO AN ELECTRICAL
CIRCUIT AND INTERCONNECTED TO ACTIVATE ALL ALARMS
IF ONE SOUNDS. BATTERY BACK-UP REQUIRED. SMOKE
ALARMS TO INCORPORATE VISUAL SIGNALLING COMPONENT.
(9.10.19.3).

44 CARBON MONOXIDE ALARM (*OBC 9.33.4.)
WHERE A FUEL-BURNING APPLIANCE IS INSTALLED IN A
DWELLING UNIT, A CARBON MONOXIDE DETECTOR
CONFORMING TO CAN/CSA-6.19, CSA 6.19 OR UL2034
SHALL BE INSTALLED ADJACENT TO EACH SLEEPING
AREA. CARBON MONOXIDE DETECTOR(S) SHALL BE
PERMANENTLY WIRED SO THAT IT IS ACTIVATION WILL
ACTIVATE ALL CARBON MONOXIDE DETECTORS AND BE
EQUIPPED WITH AN ALARM THAT IS AUDIBLE WITHIN
BEDROOMS WHEN THE INTERVENING DOORS ARE CLOSED

45 SOIL GAS CONTROL (*OBC 9.13.4.)
PROVIDE CONSTRUCTION TO PREVENT LEAKAGE OF SOIL
GAS INTO THE BUILDING AS REQUIRED.

CITY OF HAMILTON
Building Division

Permit No. 21 107161

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

FOR CHIEF BUILDING OFFICIAL DATE FEB 23 2021

2012 CODE
COMPLIANCE PACKAGE "A1"



REVISIONS	
5.	
4.	
3.	
2.	
1.	ISSUED FOR PERMIT JUL 30, 2018


The undersigned has reviewed and takes responsibility for this
design, and has the qualifications and meets the requirements set
out in the Ontario Building Code to be a designer.
QUALIFICATION INFORMATION
Required unless design is exempt under Division C, Subsection 2.2.5 of the building code
VIKAS GAJJAR 28770
NAME SIGNATURE BCIN

REGION DESIGN INC.
5700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S6
P (416) 738-4008
F (800) 680-0746


GENERAL NOTES
SCALE N.T.S.
DATE JULY 2013

CONTRACTOR SHALL CHECK ALL
DIMENSIONS AND ELEVATIONS BEFORE
COMMENCING WORK AND REPORT
ANY DISCREPANCIES TO THE DESIGNER.
PRINTS ARE NOT TO BE SCALED.
PAGE No. 1


PROJECT NAME
RUSSELL GARDENS III

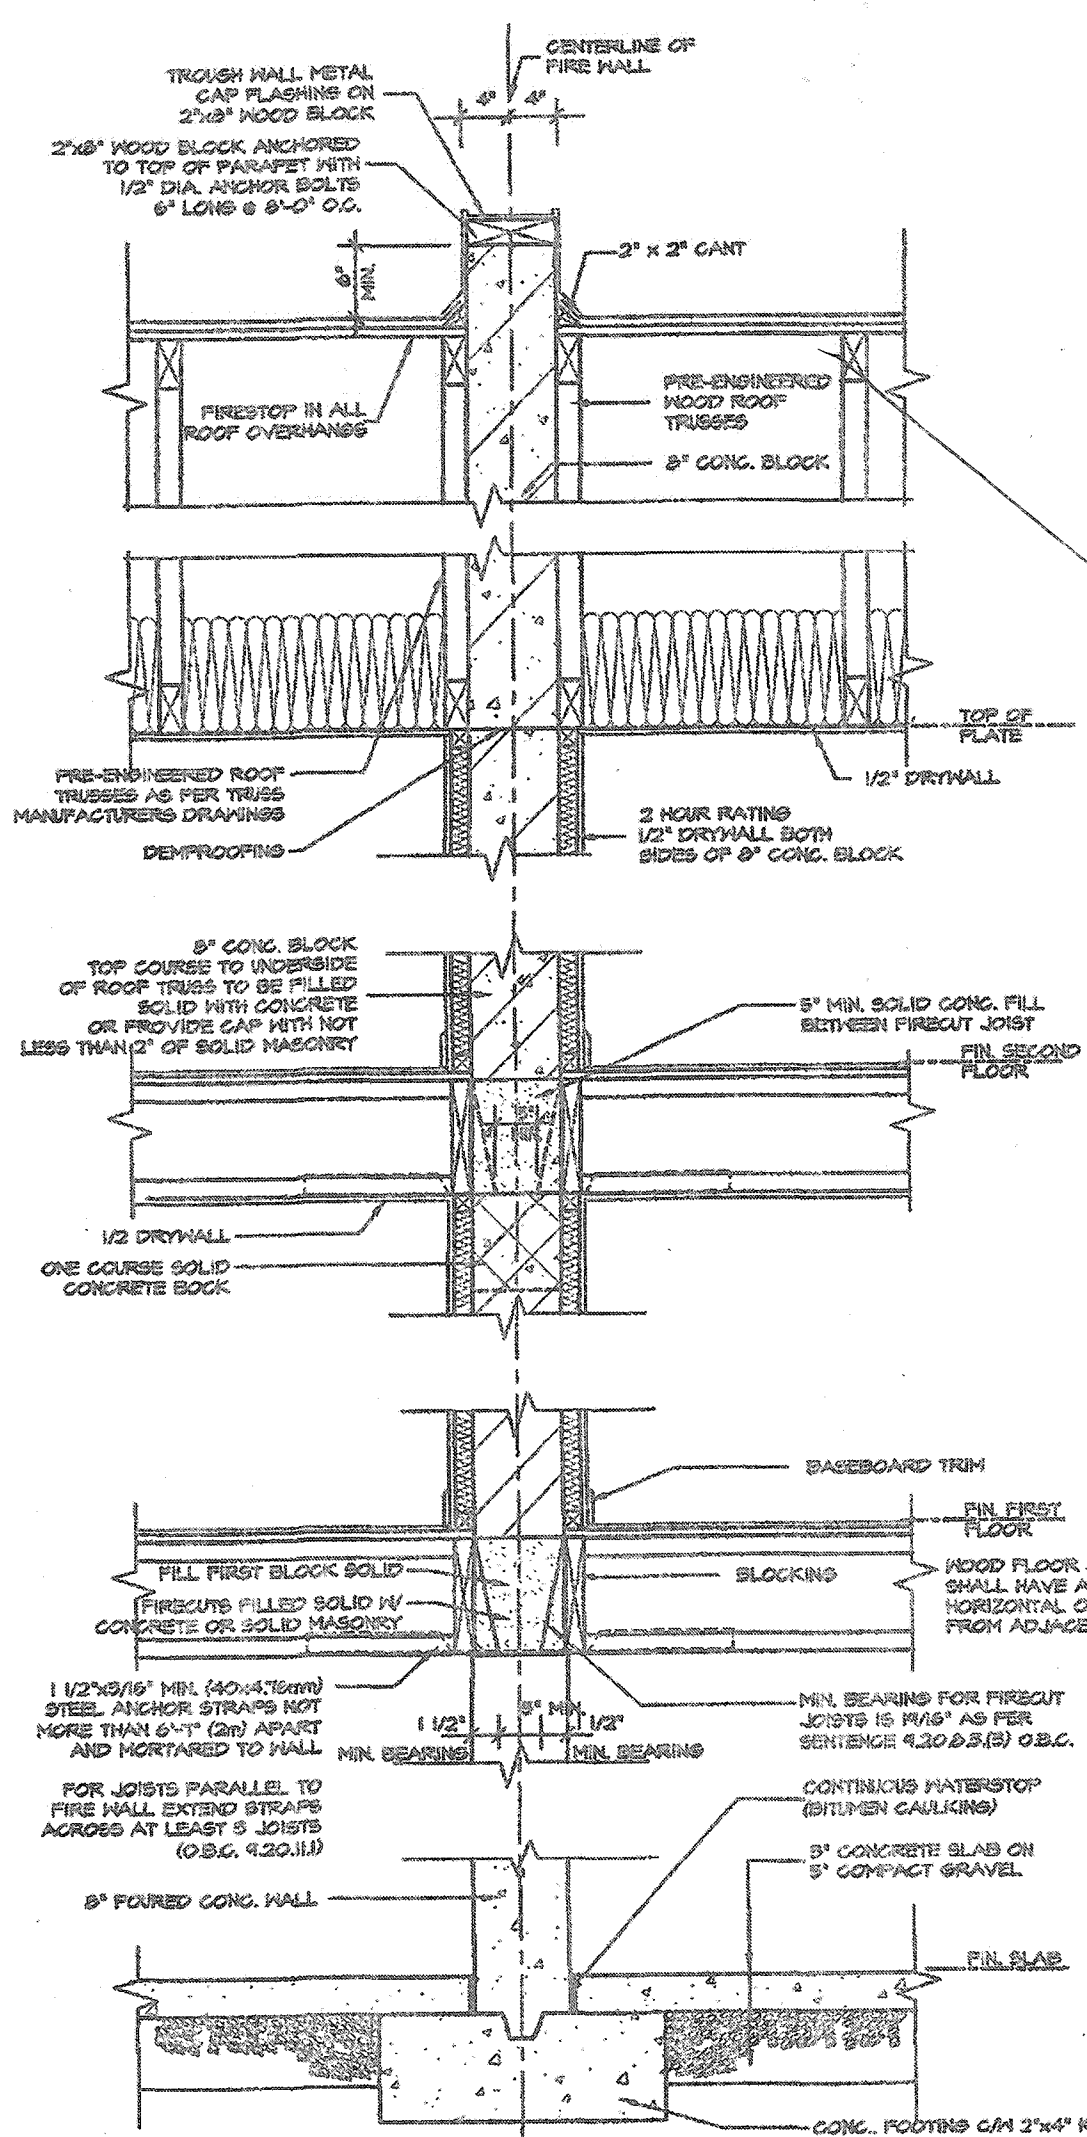

**TYPE 2 STOREY FIRE WALL SECTION
TRUSSES PARALLEL TO PARTY WALL**

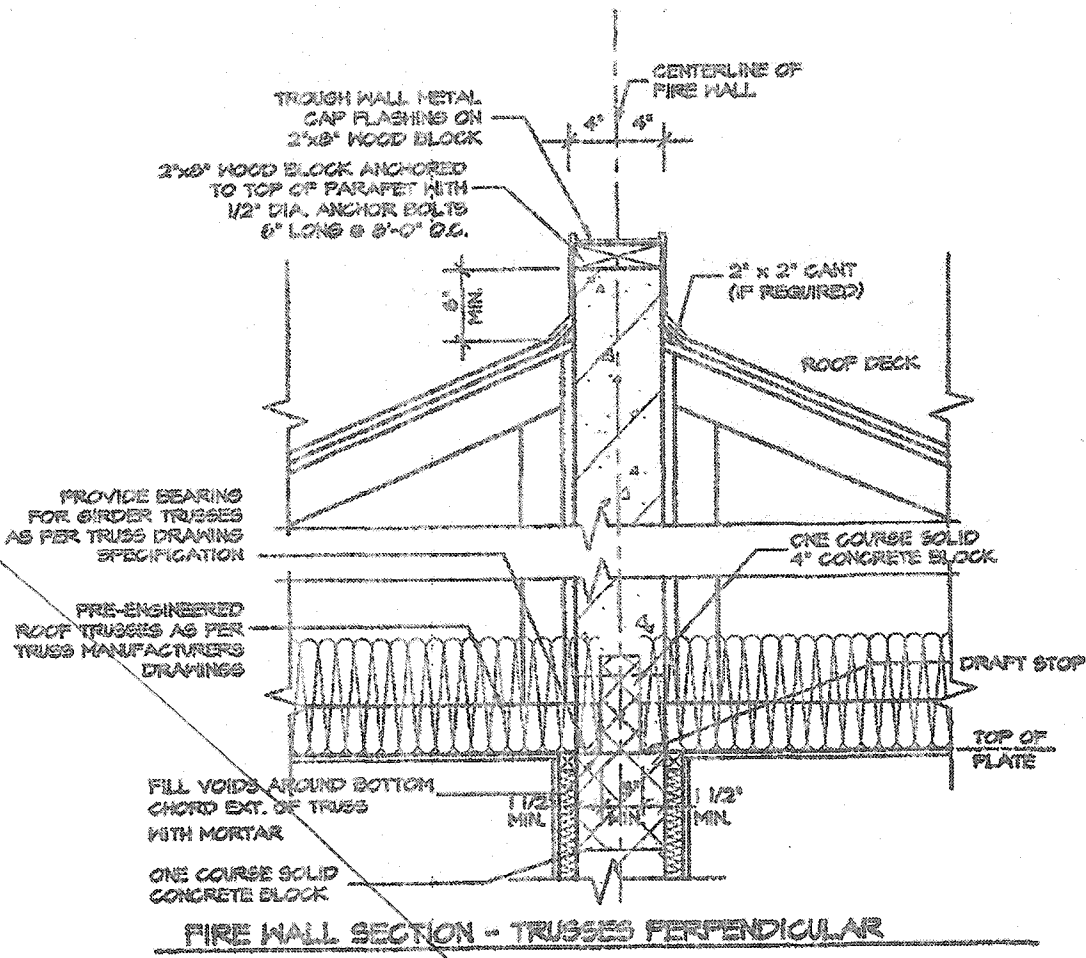

FIRE WALL SECTION - TRUSSES PERPENDICULAR

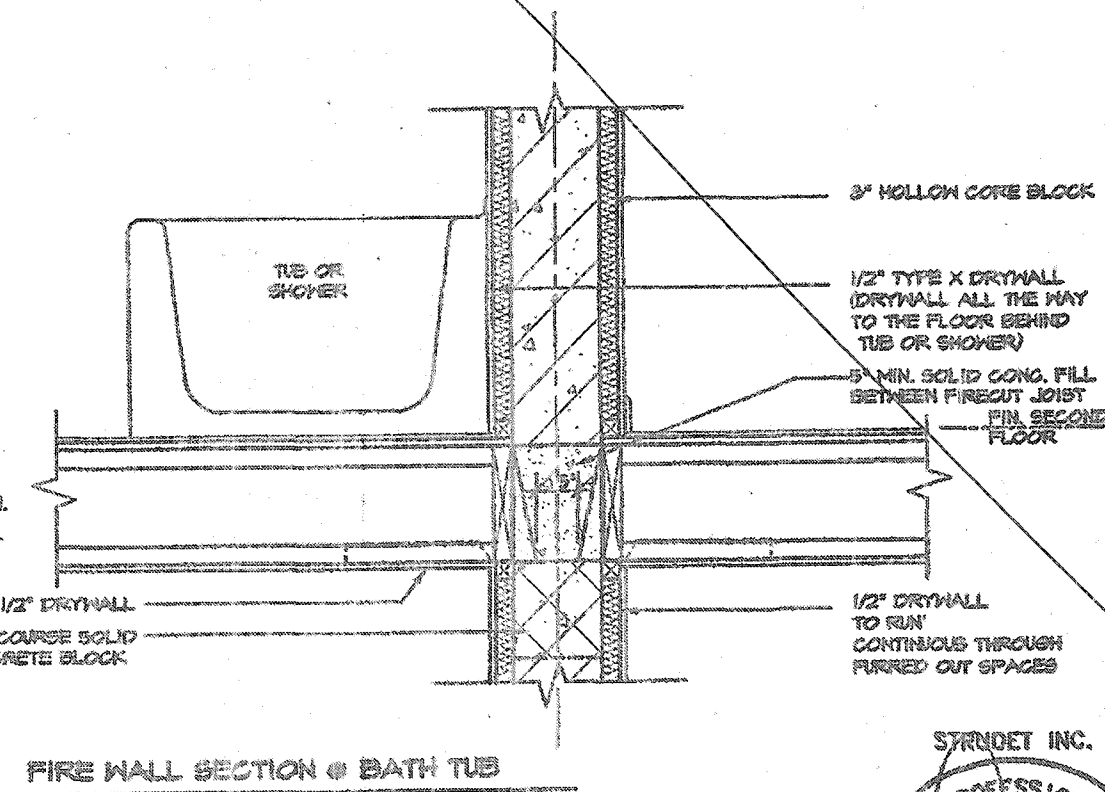

FIRE WALL SECTION @ BATH TUB


A FIREWALL SHALL EXTEND FROM THE GROUND CONTINUOUSLY THROUGH OR ADJACENT TO ALL STOREYS OF A BUILDING. (O.B.C. 3.110.5 (1))

ENGINEERED FLOOR SYSTEM INSTALLATION TO CONFORM TO MANUFACTURER'S APPROVED DETAILS AND SPECIFICATIONS


SOUND ABSORPTIVE MATERIAL REQUIREMENTS
SOUND ABSORPTIVE MATERIAL INCLUDES FIBRE PROCESSED FROM ROCK, GLASS, GLASS OR CELLULOSE FIBRE. IT MUST FILL AT LEAST 10% OF THE CAVITY THICKNESS FOR THE WALL TO PROVIDE THE LISTED STC VALUE.
SOUND TRANSMISSION RATING
MINIMUM REQUIRED S.T.C. RATING OF 50 (O.B.C. DIV. B 9.1.2.1(i))
FIRE RESISTANCE RATING
FIRE RESISTANCE RATING REQUIRED IS 2 HRL MIN (AS PER SENTENCE DIV. B 9.1.10.2 O.B.C.)
WALL TYPE
SEE SUPPLEMENTARY STANDARDS SEE TABLE 1, (WALL NO. 896) 8" (HOLLOW) CONCRETE BLOCK WALL WITH 1/2" X 1/2" STRAPPING & 1/2" DRYWALL FILLED W/ SOUND ABSORPTIVE MATERIAL EACH SIDE (PAR 2H/STC 57)

**CITY OF HAMILTON
Building Division**

Permit No. _____
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
FOR CHIEF BUILDING OFFICIAL _____ DATE _____

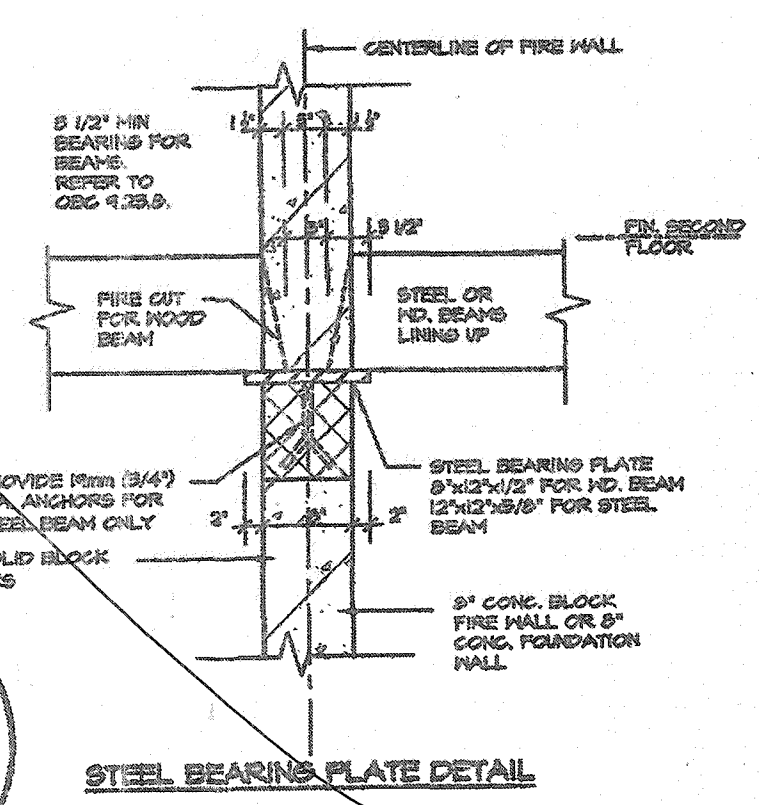

STEEL BEARING PLATE DETAIL

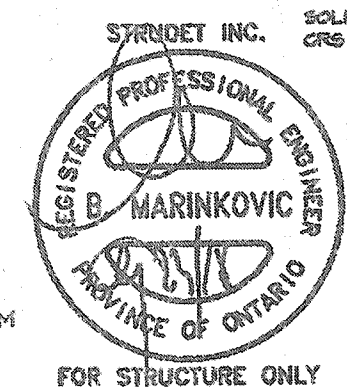

FOR STRUCTURE ONLY

**2012 CODE
COMPLIANCE PACKAGE "A1"**

5. _____ 4. _____ 3. _____ 2. _____ 1. ISSUED FOR PERMIT JUL 30, 2018 REVISIONS	The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 2.2.5 of the building code VIKAS GAJJAR 28770 NAME SIGNATURE ECIN	REGION DESIGN INC. 8700 DUFFERIN ST. CONCORD, ONTARIO L4K 4S6 P (416) 736-4046 F (905) 660-0746 REGION DESIGN INC.	SHEET TITLE FIRE WALL SCALE 3/4" = 1'-0" DATE JULY 2018	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED. PAGE No. 3	Greenpark. PROJECT NAME RUSSELL GARDENS III
---	---	---	---	---	---

TIGHTLY SEAL ANY GAPS WITH MINERAL WOOL OR NON-COMBUSTIBLE MATERIAL, AS PER O.B.C. 4.10.11.2(1)

PROVIDE BEARING FOR GIRDER TRUSSES AS PER TRUSS DRAWING SPECIFICATION
PRE-ENGINEERED ROOF TRUSSES AS PER TRUSS MANUFACTURERS DRAWINGS

TOP OF PLATE
2 LAYERS OF 1/2" GYPSUM WALL BOARD FOR FIRE-STOPPING CONTINUOUS

3 ROWS (TOP, MIDDLE AND BOTTOM) OF 1"x4" STRAPPING TO RESTRAIN INSULATION FROM FALLING OUT.

5/8" TYPE 'X' GYPSUM WALL BOARD

FIN. SECOND FLOOR

ABSORPTIVE MATERIAL

2 LAYERS OF 1/2" GYPSUM WALL BOARD FOR FIRE-STOPPING CONTINUOUS

3 ROWS (TOP, MIDDLE AND BOTTOM) OF 1"x4" STRAPPING TO RESTRAIN INSULATION FROM FALLING OUT.

5/8" TYPE 'X' GYPSUM WALL BOARD

FIN. FIRST FLOOR

JOISTS FRAMING INTO PARTY WALL

SOLID BLOCKING BETWEEN JOISTS
CONTINUOUS RIM BOARD

1/2" DIA. ANCHOR BOLTS EMBEDDED IN POURED CONC. WALL

8" POURED CONC. WALL

CONTINUOUS BOND BREAKING MATERIAL

8" CONC. SLAB ON 5" COMPACTED GRAVEL

ON BASEMENT SLAB

CONC. FTG. C/W 2"x4" KEYWAY ON NATURAL UNDISTURBED SOIL FOR SIZES SEE ARCHITECTURAL DRAWINGS

WOOD FRAME PARTY WALL TRUSSES PERPENDICULAR TO PARTY WALL



FOR STRUCTURE ONLY
50x84 (2"x4") STUDS @ 400 O.C. WITH 15.9mm (5/8") TYPE 'X' GYPSUM BOARD ONE LAYER ON EACH SIDE. SUPPLEMENTARY STANDARD SEE TABLE 1, MID WALL ASSEMBLY.

SOUND ABSORPTIVE MATERIAL REQUIREMENTS
SOUND ABSORPTIVE MATERIAL INCLUDES FIBRE PROCESSED FROM ROCK, SLAG, GLASS OR CELLULOSE FIBRE. IT MUST FILL AT LEAST 90% OF THE CAVITY THICKNESS FOR THE WALL TO PROVIDE THE LISTED STC VALUE.

SOUND TRANSMISSION RATING
MINIMUM REQUIRED S.T.C. RATING OF 50 (O.B.C. DIV. 9 4.11.2.1(1))

WALL TYPE
SEE SUPPLEMENTARY STANDARDS SEE TABLE 1, MSA BEARING WALL WITH 2 ROWS OF 2"x4" SPR @ 16" O.C. ON SEPARATE 2"x4" PLATES SET 1" APART WITH 4" ABSORPTIVE MATERIAL AND 1 LAYER 5/8" TYPE 'X' GYPSUM WALL BOARD ON EACH SIDE (SEE NOTES 5 TO TABLE 1)

FIRE RESISTANCE RATING
FIRE RESISTANCE RATING REQUIRED IS 1 HR. MIN. (AS PER SENTENCE DIV. 9 4.10.11.2(1) O.B.C.)

2 LAYERS OF 1/2" GYPSUM WALL BOARD FOR FIRE-STOPPING CONTINUOUS

1" AIR SPACE

3/4" SUBFLOOR

FIN. FIRST FLOOR

ENGINEERED FLOOR JOISTS W/HEADER

2 LAYERS OF 1/2" GYPSUM WALL BOARD FOR FIRE-STOPPING CONTINUOUS


2"x4" SILL PLATE (MAX. 2 1/2" P/F)

8" POURED CONC. FOUNDATION WALL


FIN. SLAB

CITY OF HAMILTON
Building Division

PERMIT NO. _____
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
THESE DRAWINGS AND SPECIFICATIONS HAVE BEEN REVIEWED
DATE _____
FOR CHIEF BUILDING OFFICIAL

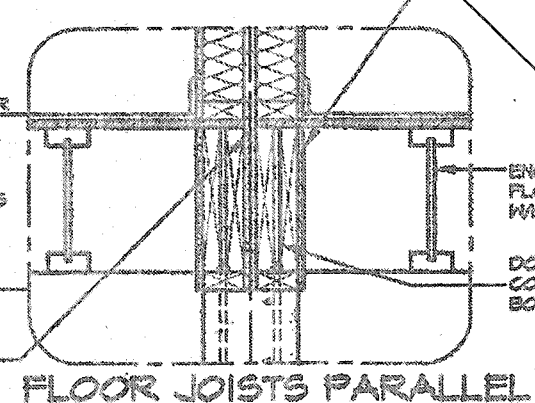

FLOOR JOISTS PARALLEL

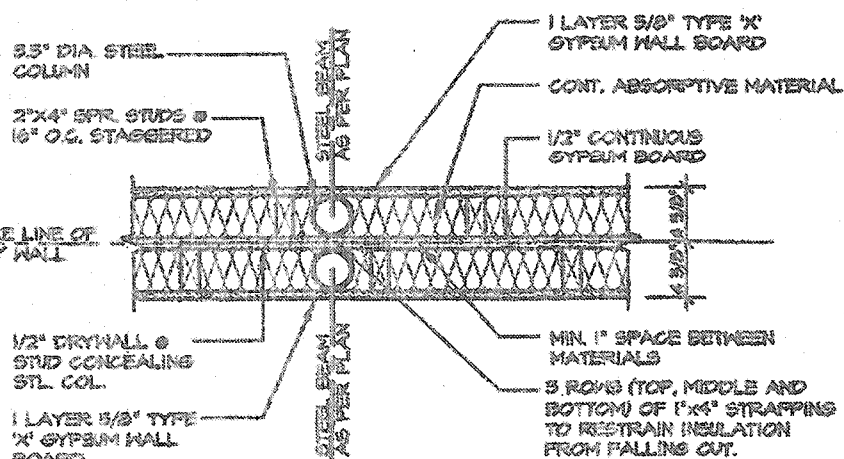

PLAN OF PARTY WALL IN GARAGE

ALL GYPSUM BOARD TO BE TIGHT-FIT AGAINST ROOF SHEATHING AND ROOF TRUSSES. MIDDLE GYPSUM BOARD BETWEEN TWO TRUSSES TO BE TIGHTLY SCREWED TO BOTH TRUSSES.


PER-ENGINEERED ROOF TRUSSES BY TRUSS MFG. @ 24" O.C.

5/8" TYPE 'X' GYPSUM WALL BOARD


TOP OF PLATE

2 LAYERS OF 1/2" GYPSUM WALL BOARD FOR FIRE-STOPPING CONTINUOUS


3 ROWS (TOP, MIDDLE AND BOTTOM) OF 1"x4" STRAPPING TO RESTRAIN INSULATION FROM FALLING OUT.

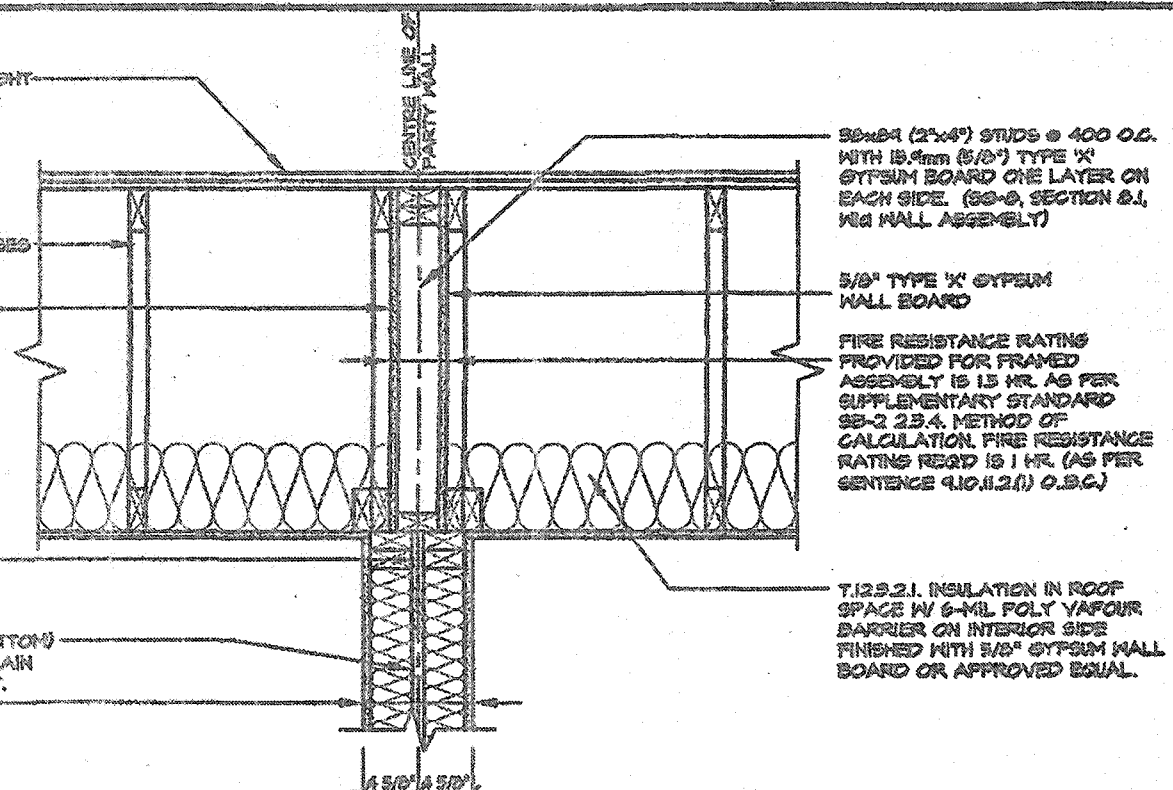

SECTION @ FIRE SEPARATION IN ROOF SPACE
TRUSSES PARALLEL TO PARTY WALL

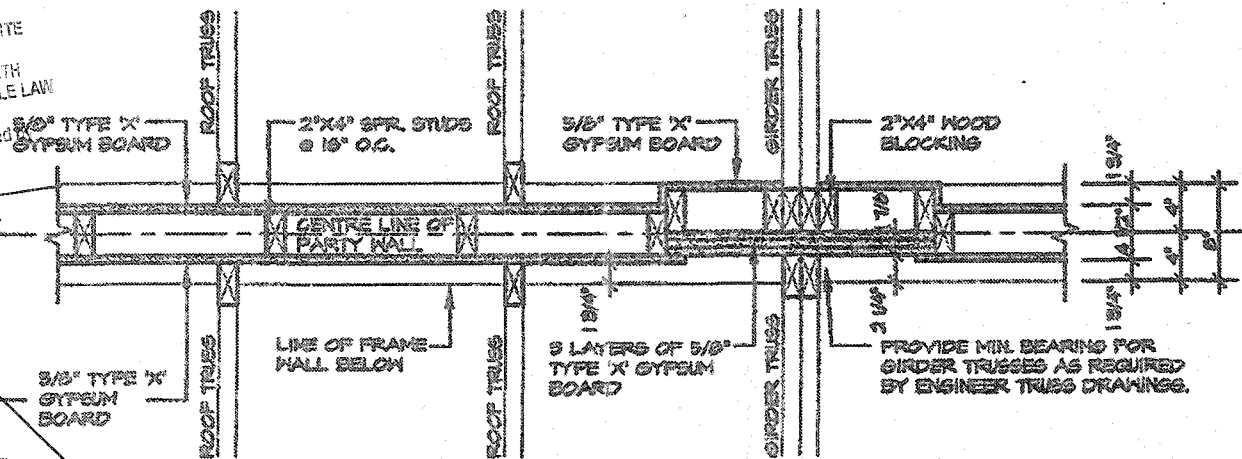

PLAN OF FIRE SEPARATION IN ROOF SPACE
TRUSSES PERPENDICULAR TO PARTY WALL

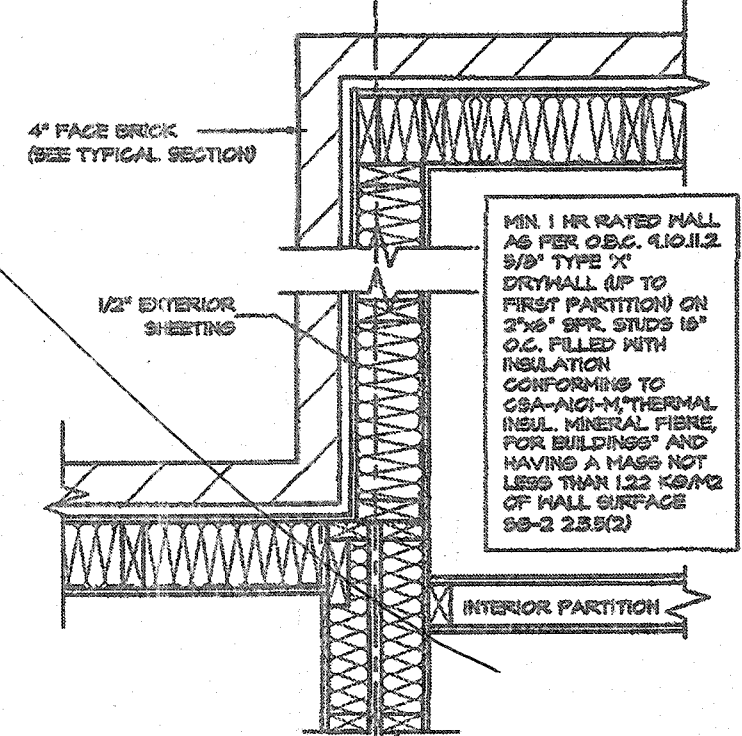

PARTY WALL PLAN SECTION

2012 CODE
COMPLIANCE PACKAGE "A1"

5.		The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 3.2.5 of the building code VIKAS GAJJAR NAME SIGNATURE 28770 BCIN	REGION DESIGN INC. 8700 DUFFERIN ST. CONCORD, ONTARIO L4K 4S6 P (416) 738-4066 F (905) 660-0746	SHEET TITLE PARTY WALL WOOD SCALE 3/4"=1'-0" DATE JULY 2018	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED. PAGE NO. 4	 PROJECT NAME RUSSELL GARDENS III
4.						
3.						
2.						
1.	ISSUED FOR PERMIT					
REVISIONS						



CONC. FOOTING C/M FORMED KEYWAY
ON NATURAL UNDISTURBED SOIL. FOR
FOOTING SIZES SEE ARCHITECTURAL
DRAWINGS.

.....

DETAIL FOR INTERIOR GARAGE WALLS & CEILING

100

018

0

FOR STRUCTURE ONLY

FOR CHIEF BUILDING OFFICIAL DATE

2 STOREY WALL SECTION

DETAIL FOR CONCRETE
VENEER DROPPED GRADE

DETAIL FOR COLD CELLAR PORCH SLAB

2012 CODE COMPLIANCE PACKAGE "A1"



PROJECT NAME
RUSSELL GARDENS III

5.		
4.		
3.		
2.		
1.	ISSUED FOR PERMIT	JUL 30, 2018
REVISIONS		

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION

Required unless design is exempt under Division C, Subsection 3.2.5 of the building code

VIKAS GAJJAR		28770
NAME	SIGNATURE	BCIN

REKON DESIGN INC.
8700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S2
P (416) 736-4038
F (905) 560-0748

REGION
DESIGN
INC.

SHEET TITLE
2"X6" BRICK VENEER
2 STOREY SECTION

SCALE
3/4"=1'-0"

DATE
JULY 2018

CONTRACTOR SHALL CHECK ALL
DIMENSIONS AND ELEVATIONS BEFORE
COMMENCING WITH WORK AND REPORT
ANY DISCREPANCIES TO THE DESIGNER.
PRINTS ARE NOT TO BE SCALED.

PAGE No.

6

 **Greenpark**

PROJECT NAME
RUSSELL GARDENS III

August 1 2018 12:33:13 PM MISTANDAR DETAIL SIDE 9 MIT SET 204 241 PACKAGE ADMINISTRATOR 3 STOREY SECTION TWO PARVACE A1 C14C

EAVE PROTECTION SHALL BE PROVIDED FROM THE EDGE OF ROOF A MIN. 8'-0" (2400mm) UP FROM THE ROOF SLOPE TO A LINE NOT LESS THAN 4'-0" (1200mm) INSIDE THE INNER FACE OF THE EXTERIOR WALL. EAVE PROTECTION SHALL BE LAID BENEATH THE STARTER STRIP AND SHALL CONSIST OF TYPE 'M' OR TYPE 'B' ASPHALT COATED ROOFING SHEETS.

210 ASPHALT SHINGLES ON 5/8" PLYWOOD SHEATHING USE 'W' CLIPS FOR TRUSSES

STARTER STRIP OF ROOF SHINGLES REQUIRED

2 1/2" FASCIA BOARD PREFINISHED METAL GUTTER, FASCIA AND VENTED SOFFIT

1 1/2" X 6" RAISED STUCCO FRIeze BOARD (TYP.)

MESH BACKDRAFTED

- FIN. COAT OF EXTERIOR ACRYLIC STUCCO
- FIBER MESH EMBEDDED IN FIBER COAT
- INSULATION BOARD (MIN. R-5) W/ GEOMETRICALLY DEFINED DRAINAGE CAVITY HAVING A MIN. CAVITY DEPTH OF 1/4"
- AIRMOISTURE BARRIER
- 7/16" EXTERIOR GRADE OSG SHEATHING
- 2" X 8" STUDS
- MIN. R-22 BATT INSULATION
- CONT. VAPOUR / AIR BARRIER
- 1/2" DRYWALL

(IF APPROVED SYSTEM, ALL MATERIALS AND SYSTEMS SHALL CONFORM TO CANALC-516.1)

CONCRETE SILL

CONTINUOUS HEADER JOIST W/ R-22 INSULATION W/ 6 MIL. VAPOUR BARRIER AND SEAL TO JOIST AND SUBFLOOR

4" FACE BRICK TIED TO STUDS WITH GALVANIZED 1/8" WIDE METAL TIES @ 16" O.C. HORIZONTAL AND 24" O.C. VERTICAL

SCREENED WEEPING HOLES 5/8" DIA. AT 24" O.C. AT BOTTOM OF CAVITY @ MIN. POLYETHYLENE BASE FLASHING BENEATH WEEPING AND 6" UP BEHIND BUILDING PAPER

HEAVY COAT OF BITUMEN OVER CONC. WALL

FOUNDATION WALLS TO BE WATER PROOFED OR PROVIDE A DRAINAGE LAYER ADJACENT TO EXT. SURFACE OF FOUNDATION WALL AND EXTEND TO FOOTING LAYER OR PROVIDE "SYSTEM PLANTION AIR GAP MEMBRANE"

CEMENT COVE

4" DIA. WEEPING TILES W/ 1" CRUSHED STONE COVER

CONC. FOOTING CAN FORMED KEYWAY ON NATURAL UNDISTURBED SOIL. FOR FOOTING SIZES SEE ARCHITECTURAL DRAWINGS.

2 STOREY WALL SECTION

BAFFLES AS REQUIRED FOR ROOF VENTILATION

PROVIDE ROOF VENTILATION @ A RATE OF 1:300 OF INSULATED CEILING AREA UNIFORMLY DISTRIBUTED

ROOF TRUSSES @ 24" O.C. MAX. RAISED NEEL TO MATCH PLATE

TOP OF WOOD PLATE

1/2" (12mm) DRYWALL FINISH OVER CONT. 6 MIL. POLY VAPOUR/AIR BARRIER & MIN. R-20 INSULATION

MIN. R-22 INSULATION ABOVE INNER FACE OF EXTERIOR WALL

DOUBLE TOP PLATE

1/2" GYPSUM BOARD

2 1/2" BOTTOM PLATE

LAP VAPOUR AND AIR BARRIER 4" AND SECURE TO PLATE

FIN. FLOORING ON 5/8" T&G PLYWOOD

FINISHED SECOND FLOOR

PARALLEL JOISTS, TJI WOOD BLOCKING @ 55" O.C.

FLOOR JOISTS SEE PLAN

1/2" GYPSUM BOARD CEILING FINISH

SINGLE CONT. TIMBERSTRAND

AIR BARRIER RUN BETWEEN DOUBLE TOP PLATE AND UP UNDER FLOOR PLATE

DOUBLE TOP PLATE

1/2" GYPSUM BOARD

SINGLE CONTIN. TIMBERSTRAND

FIN. FLOORING ON 3/4" T&G PLYWOOD

FINISHED FIRST FLOOR

CAULK OR SEAL WITH GASKET

AIR BARRIER SECURED TO PLATE

2 1/4" WOOD PLATE ANCHORED TO FOUNDATION WALLS WITH 1/2" DIA. BOLTS AT 14" O.C. MIN. 4" INTO FOUNDATION WALL

R-20 BLANKET INSULATION DOWN WITHIN 2" MIN. AND 8" MAX. ABOVE FINISH SLAB WITH MOISTURE & VAPOUR BARRIER SEALED AT TOP & BOTTOM

POURED CONC. FDN. WALL FOR WALL THICKNESS SEE ARCHITECTURAL DRAWINGS.

CONTINUOUS WATERSTOP (BITUMEN CAULKING)

8" CONCRETE SLAB 25 MPa ON 4" MIN. COMPACT GRAVEL

FINISHED SLAB

CITY OF HAMILTON Building Division


Permit No. 21 107141

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

FOR CHIEF BUILDING OFFICIAL DATE FEB 23 2021

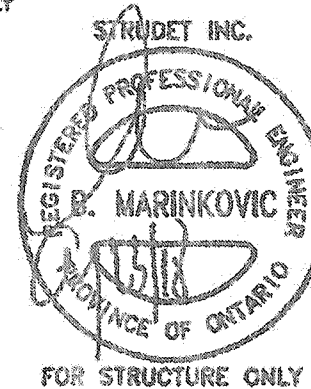

FOR STRUCTURE ONLY

WOOD SHEATHING

AIRMOISTURE BARRIER

FIBER MESH EMBEDDED IN FIBER COAT

INSULATION BOARD (R-5) W/ GEOMETRICALLY DEFINED DRAINAGE CAVITY HAVING A MIN. CAVITY DEPTH OF 1/4"

STARTER MESH (BACKDRAFTED)

CAULK WITH SEAD VENT


FLASHING

CONCRETE SILL


MASONRY CLADDING AS PER ELEVATION

A. TERMINATION AT MASONRY CLADDING WITH SEALANT

1 1/2" = 1'0"

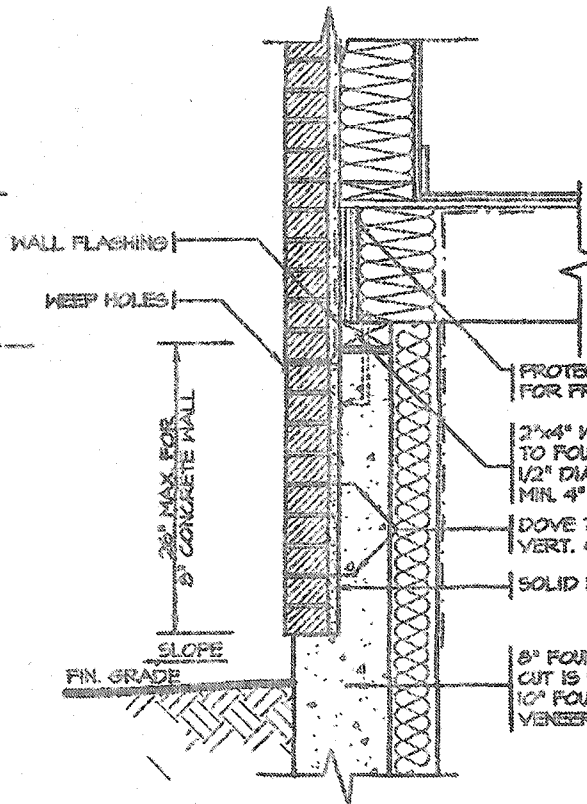

DETAIL FOR CONCRETE VENEER DROPPED GRADE

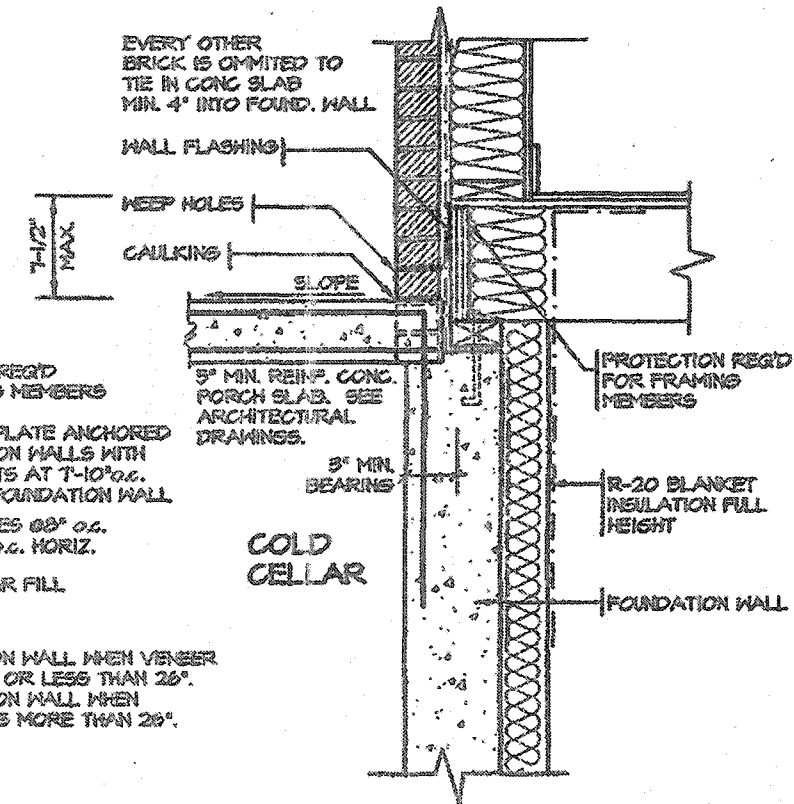

DETAIL FOR COLD CELLAR PORCH SLAB

2012 CODE COMPLIANCE PACKAGE "A1"

5.	
4.	
3.	
2.	
1.	ISSUED FOR PERMIT JUL 30, 2018

REVISIONS

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION

Required unless design is exempt under Division C, Subsection 3.2.5 of the building code

VIKAS GAJJAR 28770

NAME SIGNATURE BCIN

REGION DESIGN INC.

8700 BARTER ST.

CONCORD, ONTARIO

L4M 4S8

P (416) 736-4096

F (905) 560-0745

REGION DESIGN INC.

SHEET TITLE

2"X6" STUCCO WALL

2 STOREY SECTION

SCALE

AS NOTED

DATE

JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.




PAGE NO.

6-2

PROJECT NAME

RUSSELL GARDENS III

Greenpark

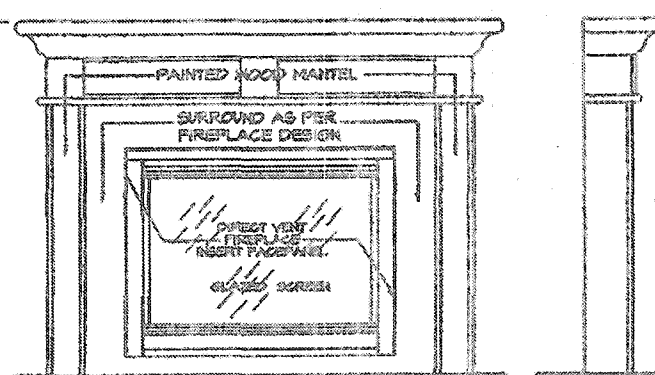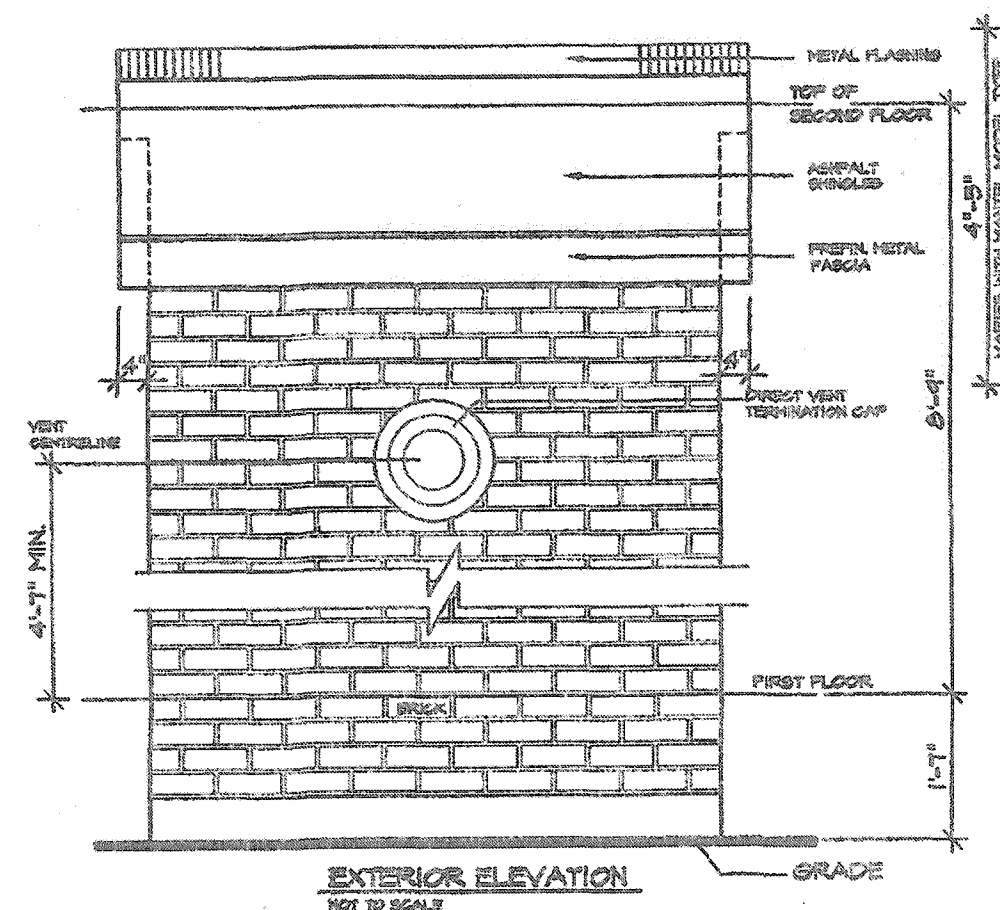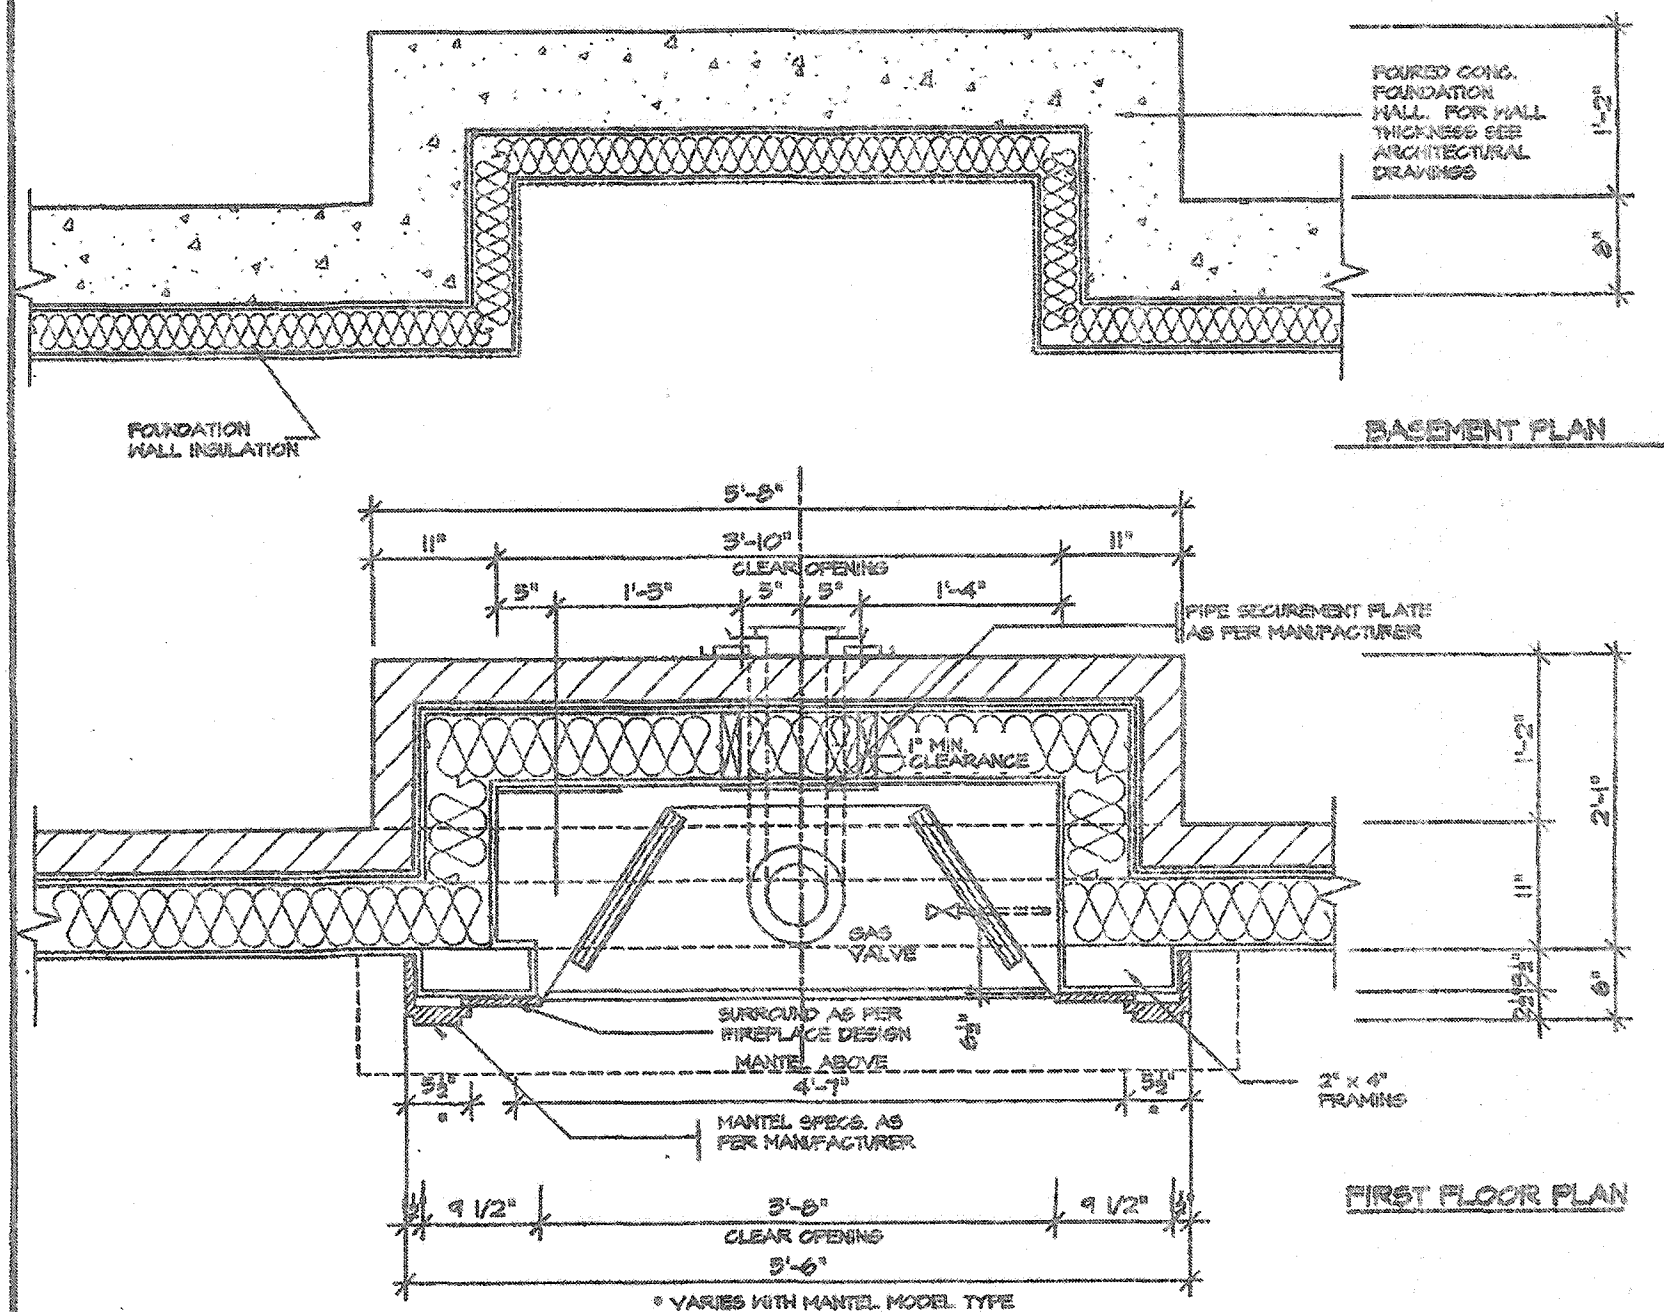

FRONT/SIDE ELEVATION
NOT TO SCALE

GENERAL INSTALLATION NOTES


1.0 UNIT INSTALLATION TO STRICTLY CONFORM TO MANUFACTURERS INSTALLATION MANUAL AND ALL APPLICABLE CODES OF LOCAL AUTHORITIES HAVING JURISDICTION INCLUDING CAN/CSA-B149.1 § 2.

2.0 INSTALL WITH THE FOLLOWING MINIMUM CLEARANCES TO COMBUSTIBLES:


- FROM TOP OF UNIT 0"
- FROM BACK OF UNIT 1/2"
- FROM SIDES OF UNIT 1/2"
- FROM TOP OF HORIZ. VENT 5"
- FROM SIDES TO VENT 1"

3.0 THE DIRECT VENT UNIT ILLUSTRATED IS THE GC500 MODEL AS MANUFACTURED BY HEATILATOR.

4.0 THE MANTLE ILLUSTRATED IS THE S-2 GB AS SUPPLIED BY GREATER TORONTO FIREPLACE.

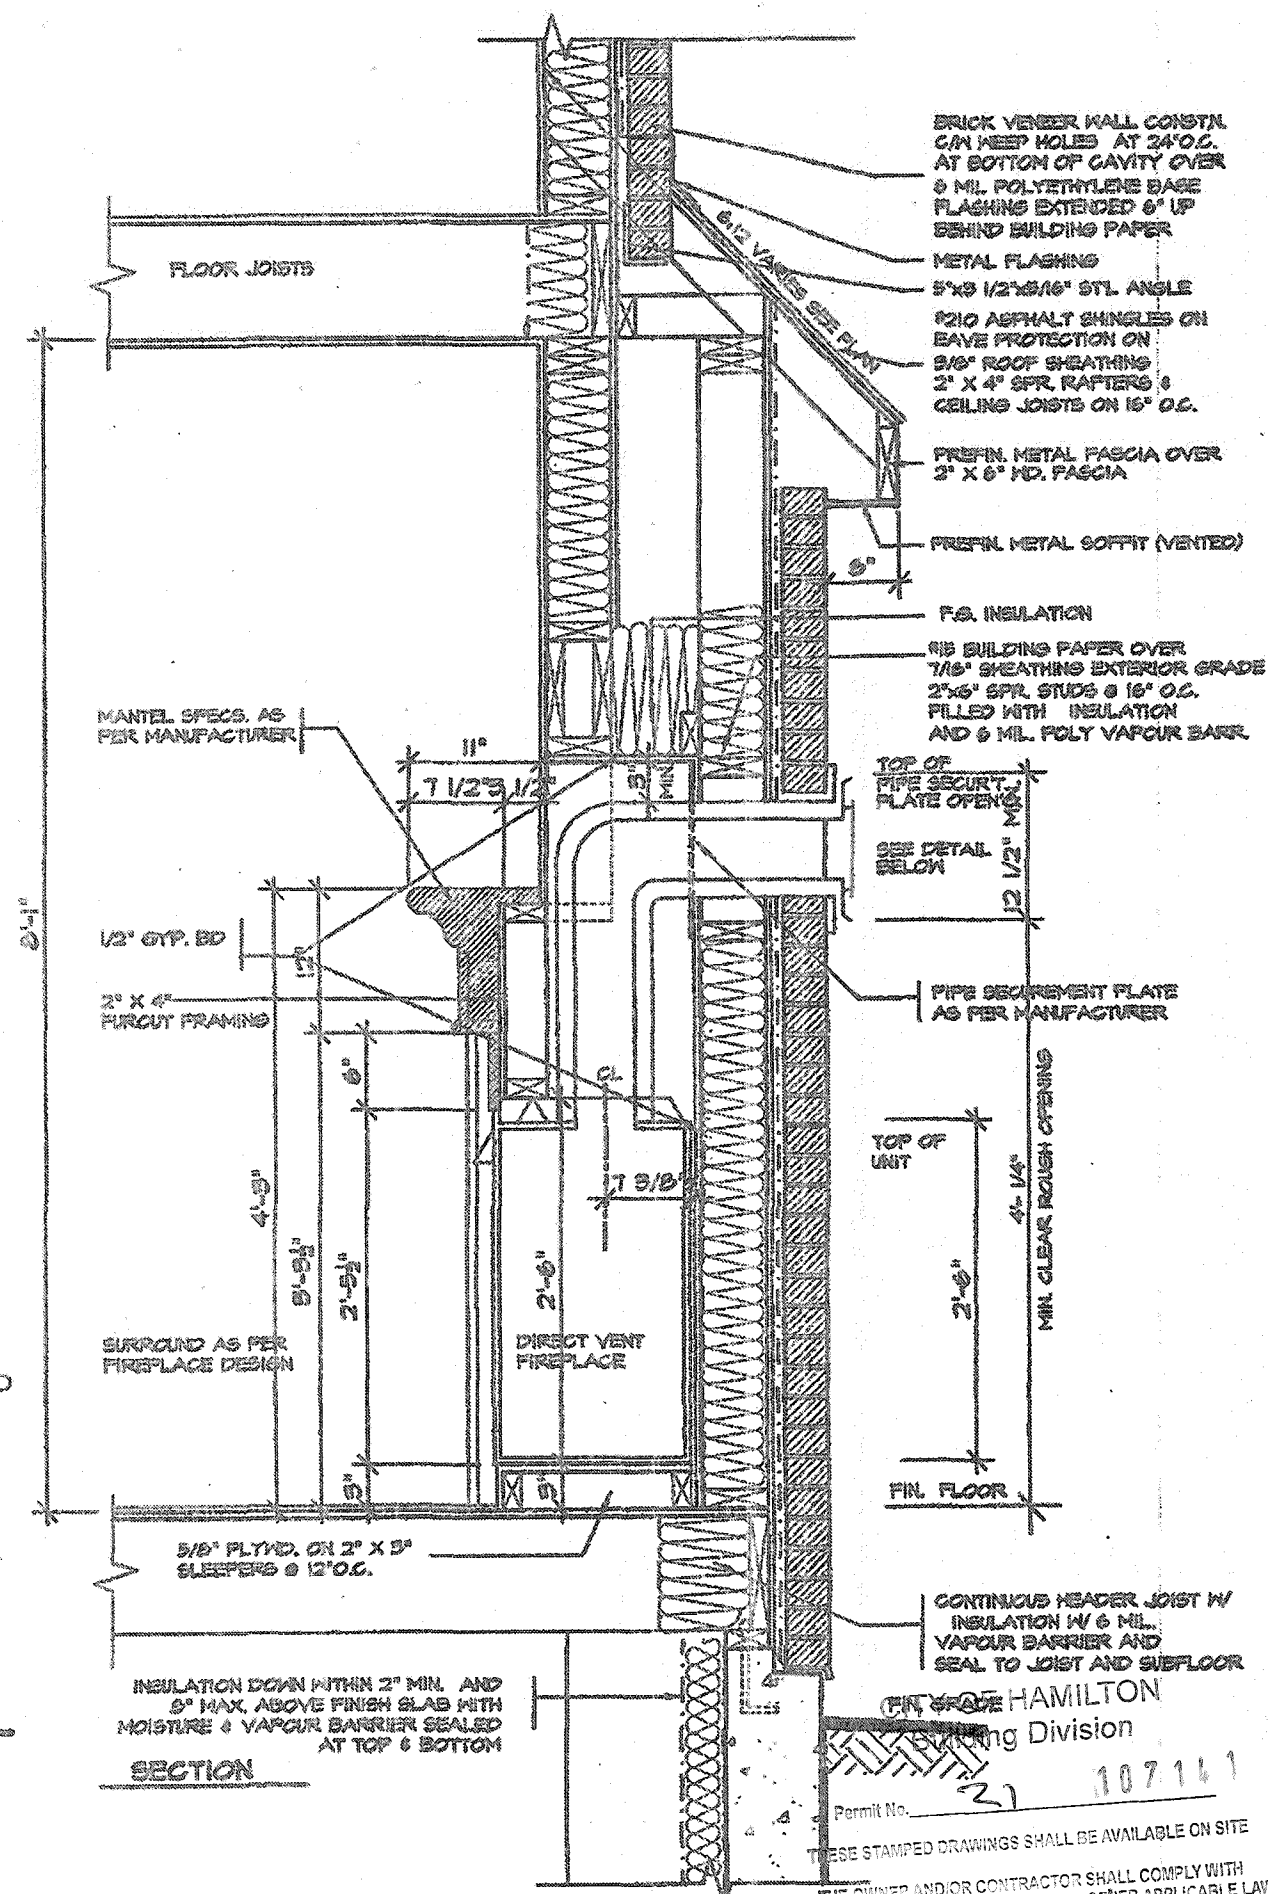





STROUD INC

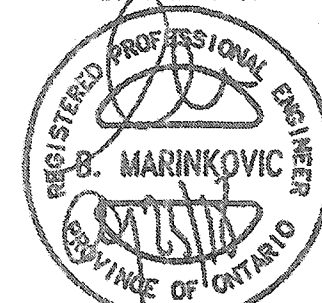

FOR STRUCTURE ONLY

**2012 CODE
COMPLIANCE PACKAGE "A1"**

5.			The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 3.2.5 of the building code VIKAS GAJJAR  28770 NAME SIGNATURE BCIN	REGION DESIGN INC. 8700 DUFFERIN ST. CONCORD, ONTARIO L4K 4S8 P (416) 738-4188 F (905) 660-0746	REGION DESIGN INC.	SHEET TITLE VENT FIREPLACE DIRECT	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENSING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.	 Greenpark.
4.						SCALE 3/4"=1'-0"	PAGE No. 7	
3.						DATE JULY 2018	PROJECT NAME RUSSELL GARDENS III	
2.								
1.	ISSUED FOR PERMIT	JULY 30, 2018						
REVISIONS								

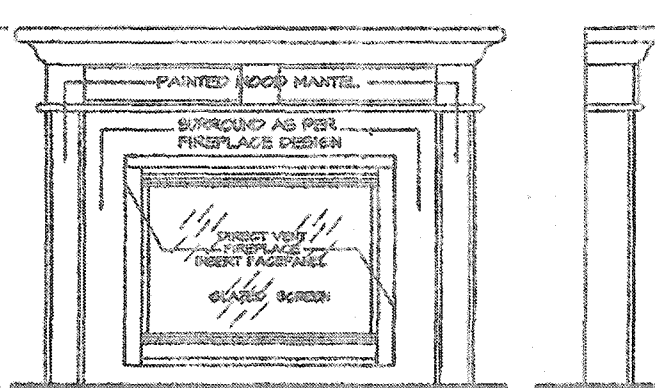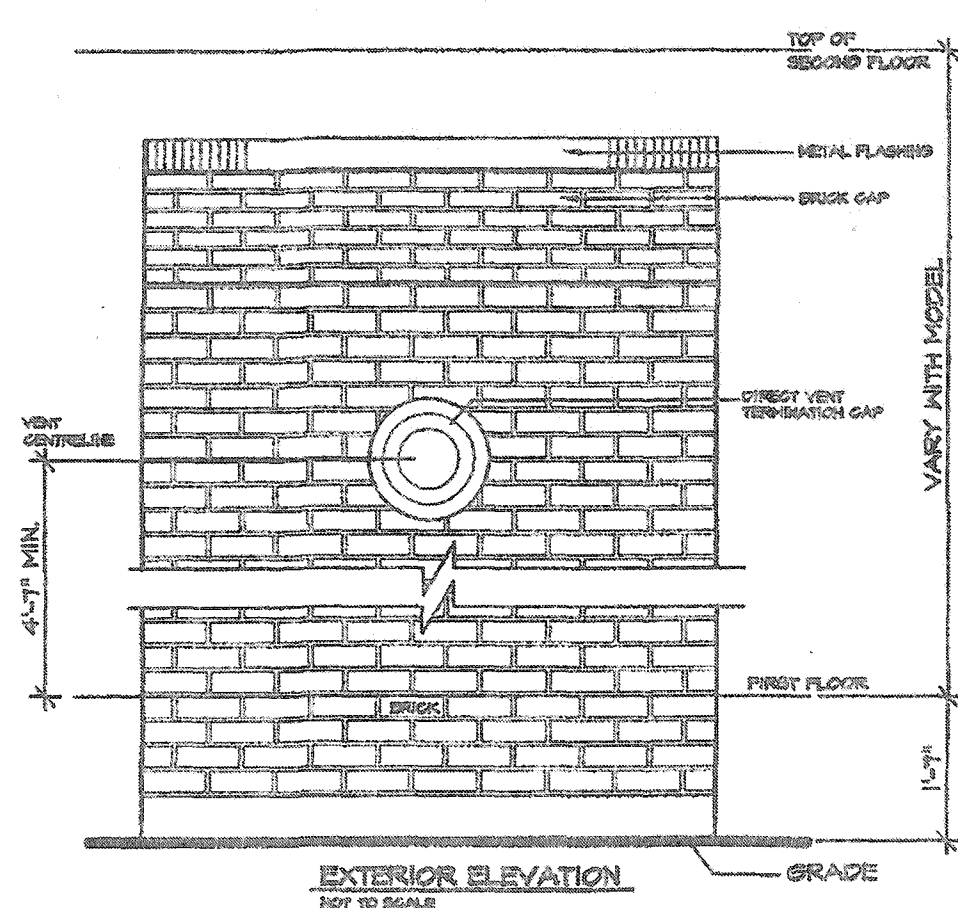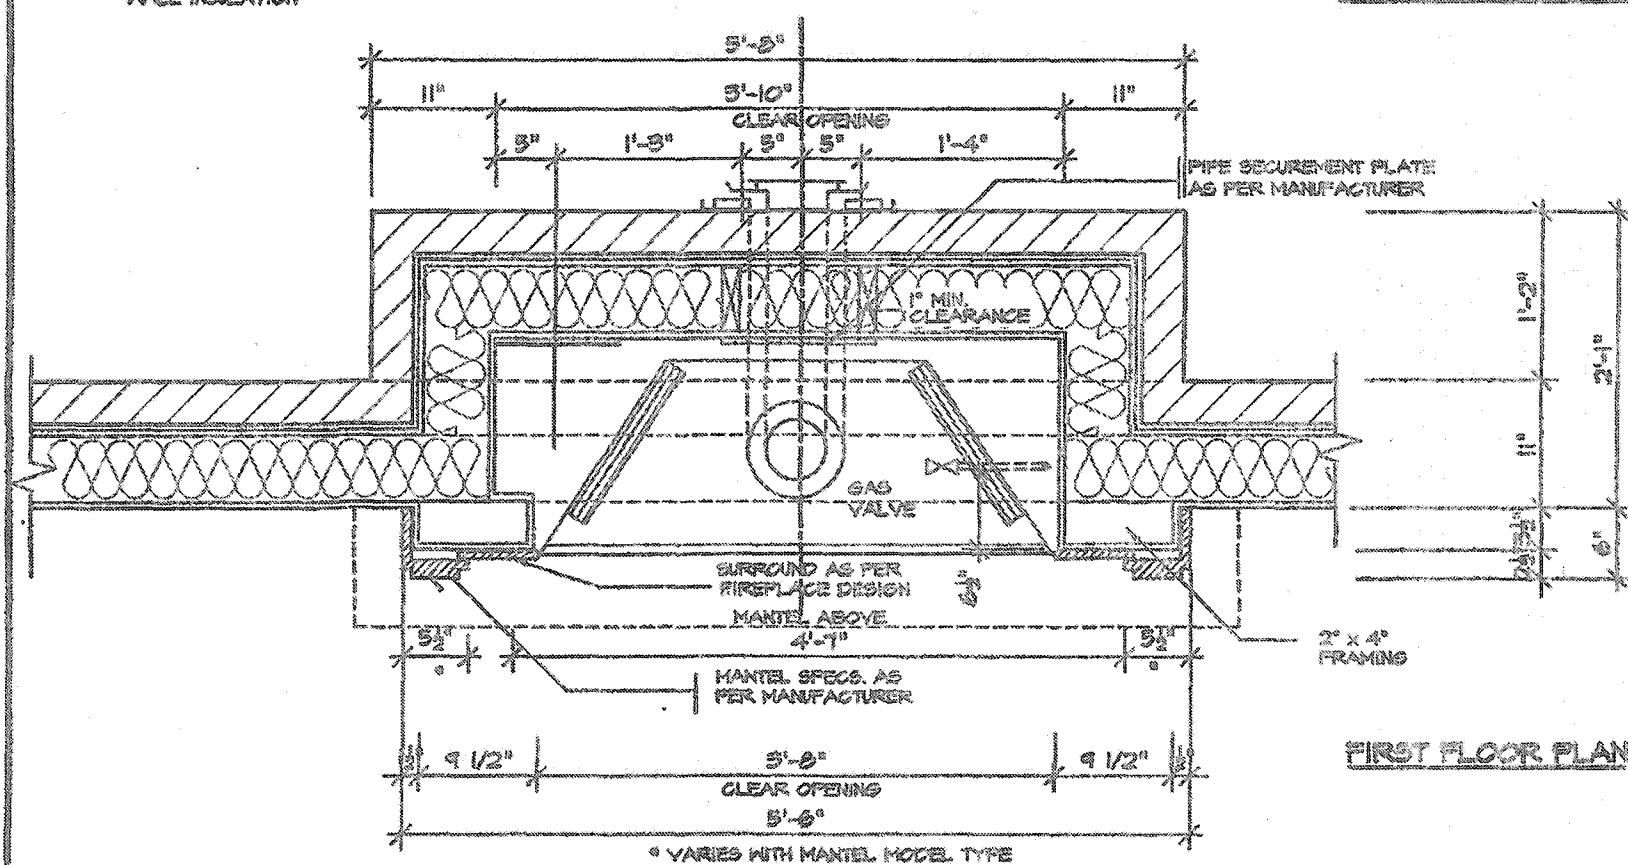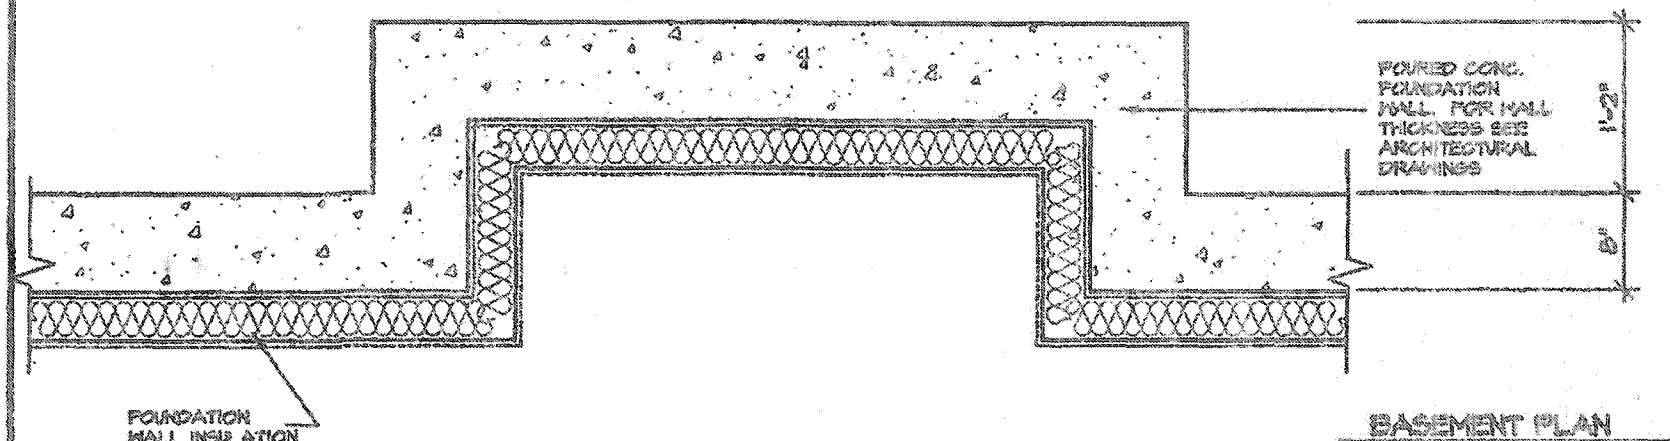

GENERAL INSTALLATION NOTES



1.0 UNIT INSTALLATION TO STRICTLY CONFORM TO MANUFACTURER'S INSTALLATION MANUAL AND ALL APPLICABLE CODES OF LOCAL AUTHORITIES HAVING JURISDICTION INCLUDING CAN/CSA-B149.1 & 2.

2.0 INSTALL WITH THE FOLLOWING MINIMUM CLEARANCES TO COMBUSTIBLES:

- FROM TOP OF UNIT 0"
- FROM BACK OF UNIT 1/2"
- FROM SIDES OF UNIT 1/2"
- FROM TOP OF HORIZONTAL VENT 5"
- FROM SIDES TO VENT 1"

3.0 THE DIRECT VENT UNIT ILLUSTRATED IS THE GC150 MODEL AS MANUFACTURED BY HEATILATOR.

4.0 THE MANTLE ILLUSTRATED IS THE S-2 GB AS SUPPLIED BY GREATER TORONTO FIREPLACE.

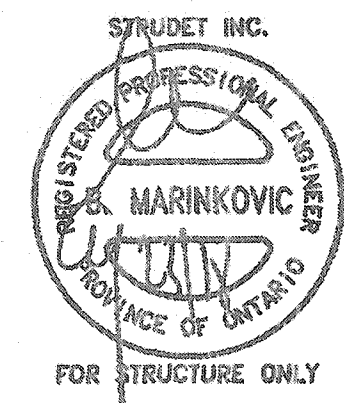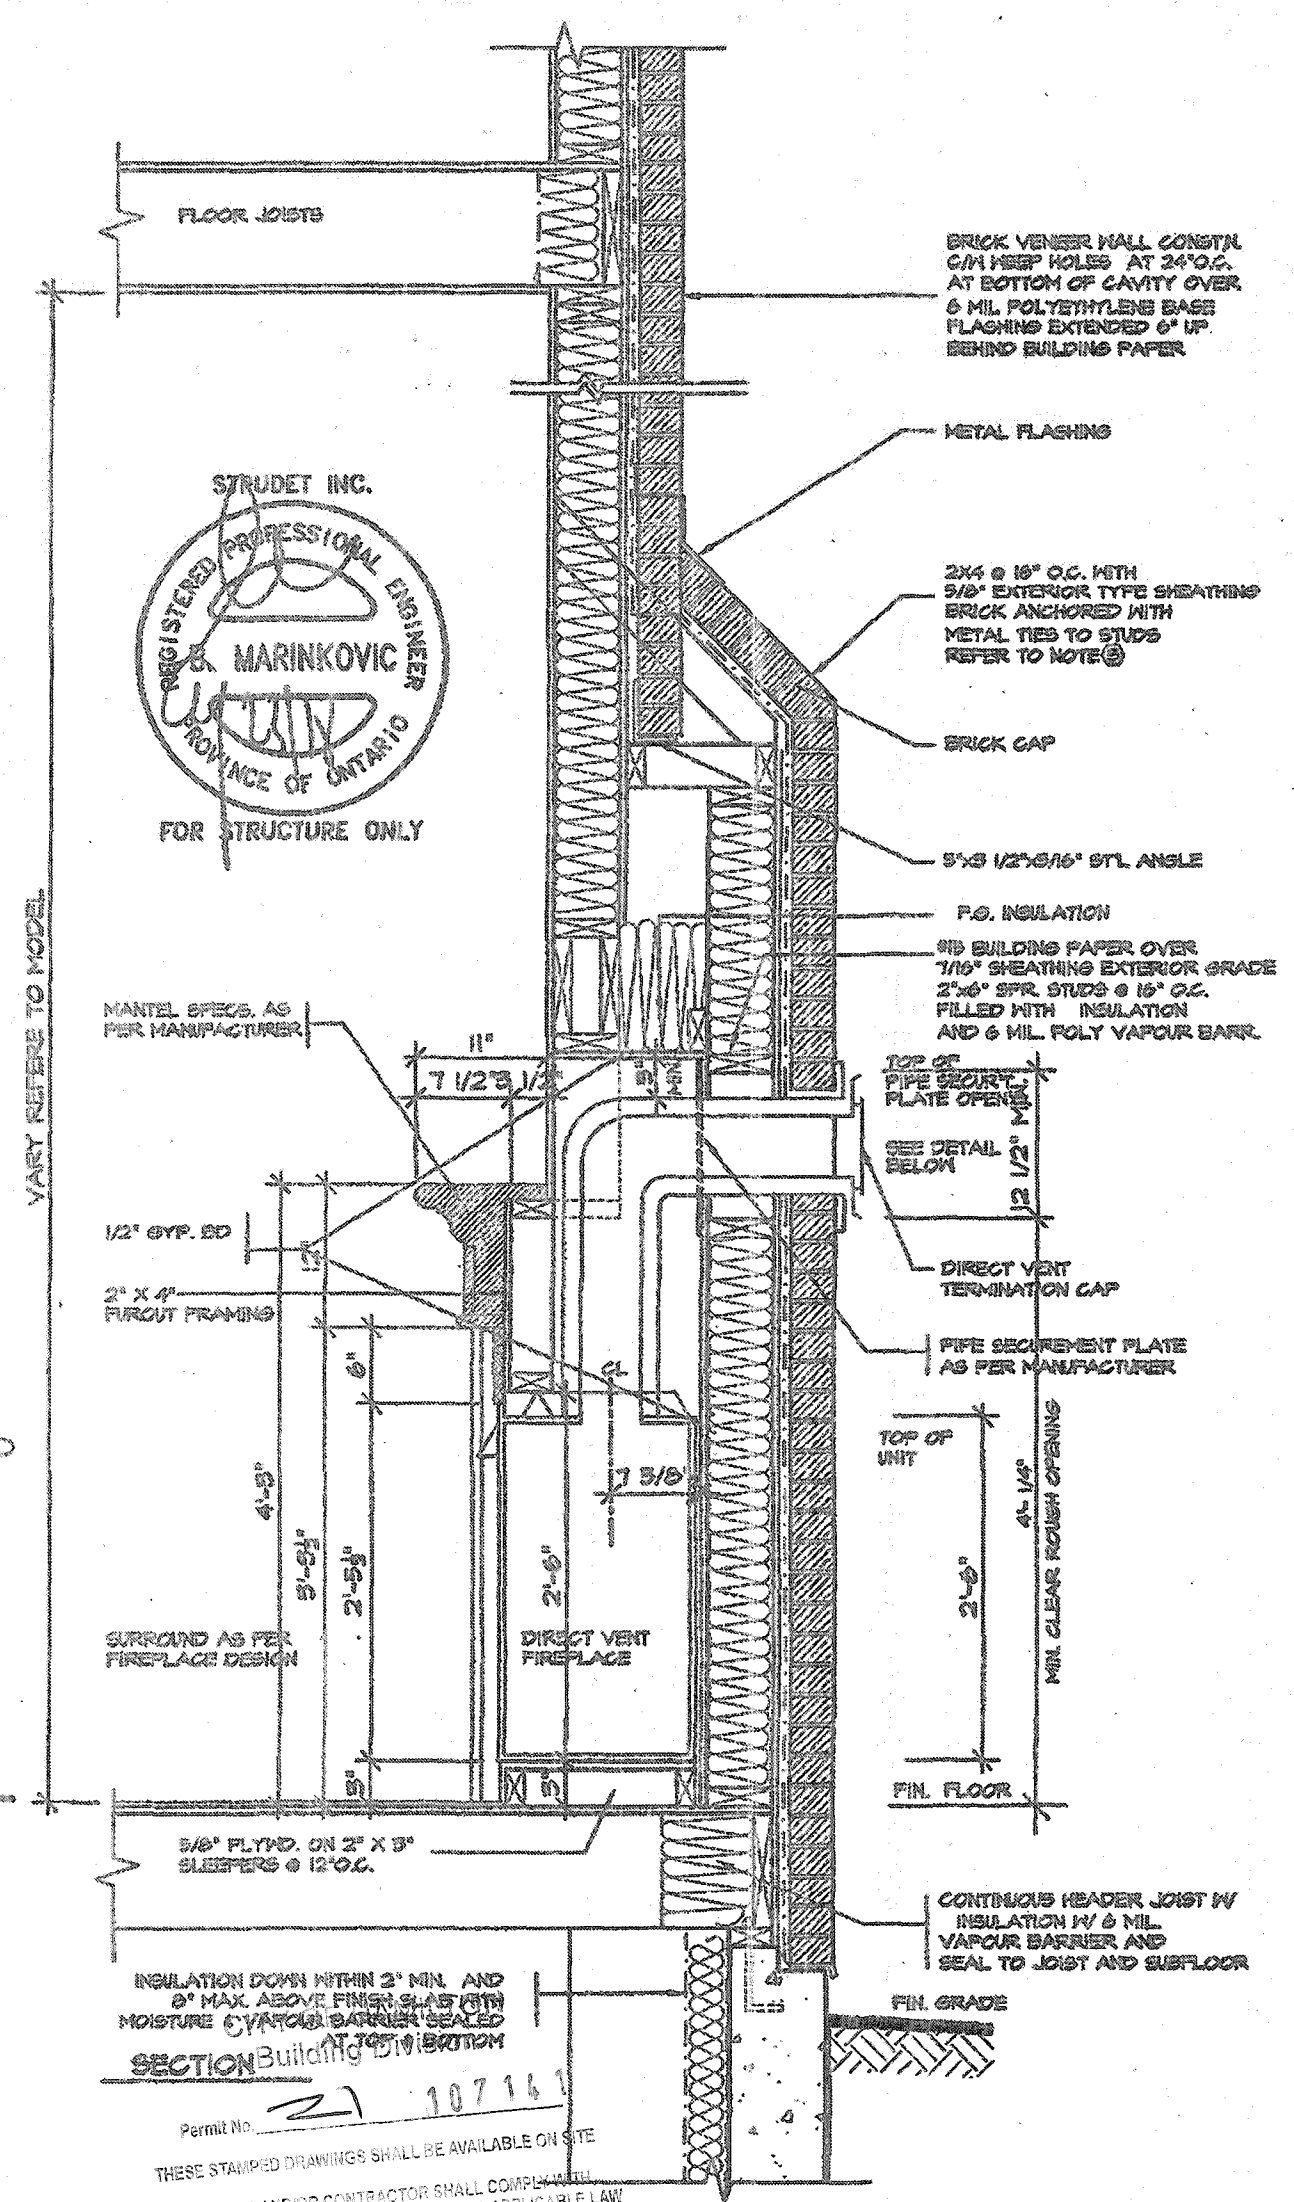

VARY REFERENCE TO MODEL

Permit No. 21 107161

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by


FOR CHIEF BUILDING OFFICIAL

FEB 23 2021


DATE

2012 CODE COMPLIANCE PACKAGE "A1"


REVISIONS 1. ISSUED FOR PERMIT JUL 30, 2018	The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 3.2.5 of the building code VIKAS GAJJAR NAME SIGNATURE 28770 BCIN	REGION DESIGN INC. 8700 BURNHAM ST. CONCORD, ONTARIO L1K 4S6 P (416) 736-4008 F (905) 860-0746	SHEET TITLE VENT FIREPLACE DIRECT SCALE 3/4"=1'-0" DATE JULY 2018	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED. PAGE No. 7-2	Greenpark. PROJECT NAME RUSSELL GARDENS III
---	--	--	---	---	---

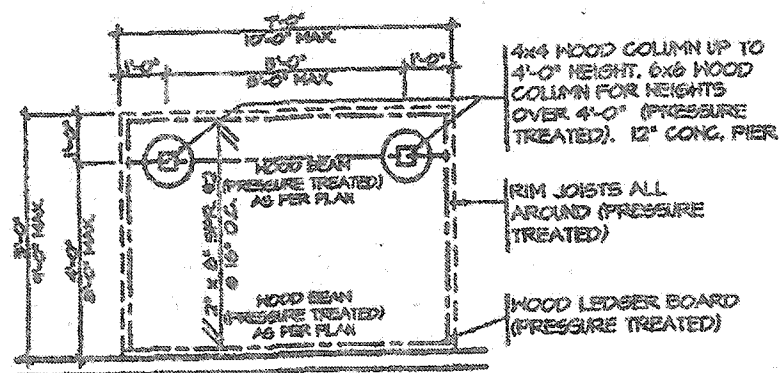


TYPICAL DECK LAYOUT
SCALE: 1/4"=1'-0"

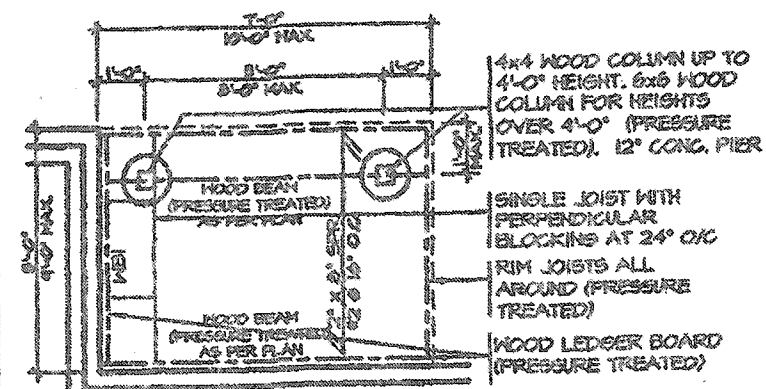

TYPICAL DECK LAYOUT
SCALE: 1/4"=1'-0"

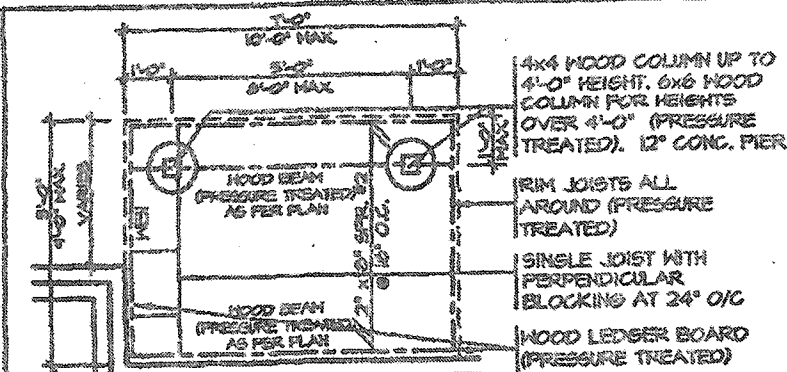

TYPICAL DECK LAYOUT
SCALE: 1/4"=1'-0"

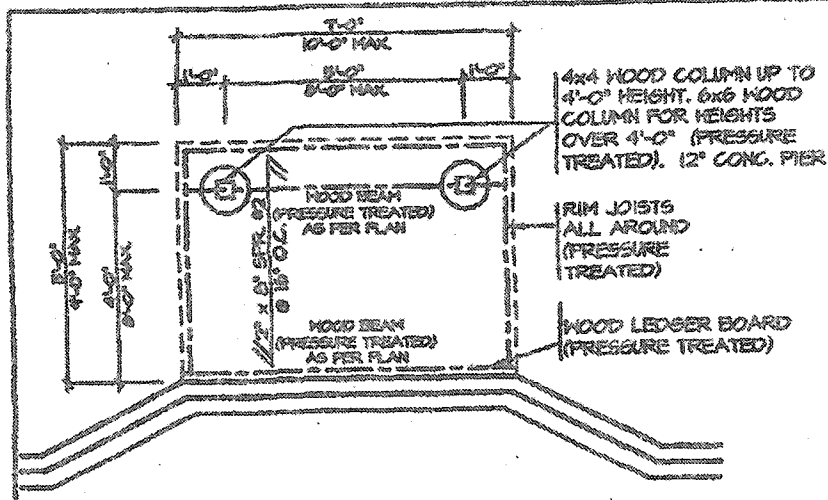

TYPICAL DECK LAYOUT
SCALE: 1/4"=1'-0"

2" x 2" PICKETS CHAMFERED AT BOTTOM WITH 2" x 6" TOP CAP AND 2" x 4" TOP RAIL (REFER TO DETAIL 1)

3'-6" HIGH WOOD RAILING IF DECK FLOOR IS MORE THAN 5'-11" ABOVE GRADE AND 3'-0" HIGH WOOD RAILING IF DECK IS LESS THAN 5'-11" ABOVE GRADE

MAX. 4" OPENING BETWEEN PICKETS

5/4x6 (PRESSURE TREATED) DECKING WITH 1/4" GAP

RIM JOISTS (PRESSURE TREATED)

GUARDS FOR STAIRS SHALL NOT BE LESS THAN 2'-11" HIGH MEASURED VERTICALLY FROM A LINE DRAWN THROUGH THE OUTSIDE EDGES OF THE STAIR NOSINGS

2x4 WOOD BLOCKING @ 4'-0" O.C. MIN. BETWEEN STRINGERS

2x12 STRINGER


PRECAST CONCRETE SLAB

(CORROSION RESISTANT) SIMPSON STRONG-TIE COLUMN BASE, 1/2" DIA. ANCHOR BOLT.



12" CONC. PIER

DECK SECTION WITH BRICK VENEER
SCALE: 1/2"=1'-0"

DETAIL 1
CANTILEVERED PICKET SCREWED TO RIM JOIST AND DECK
GUARD PARALLEL TO FLOOR JOISTS
SCALE: 1"=1'-0"

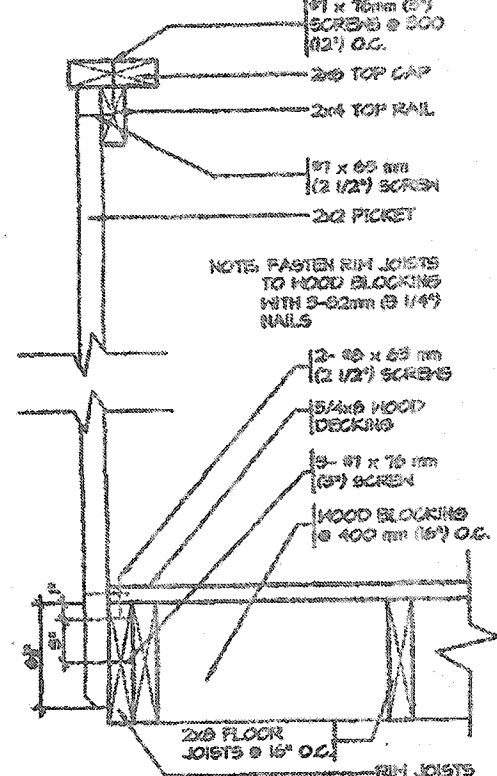

DETAIL 2
GUARD PERPENDICULAR TO FLOOR JOISTS
SCALE: 1"=1'-0"

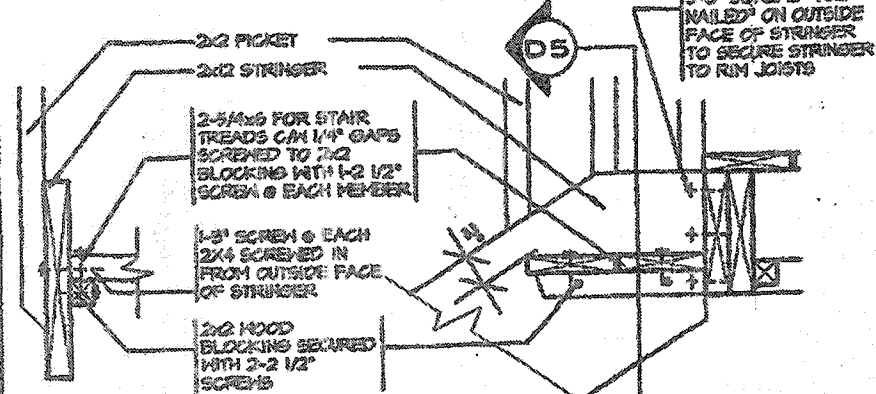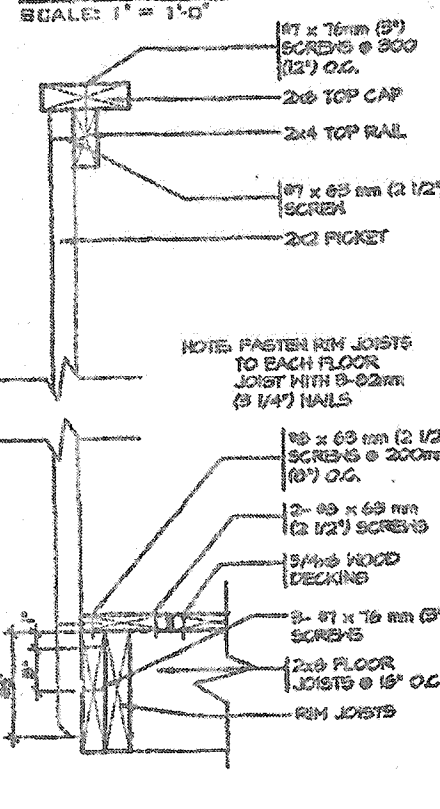

DETAIL 5
SECTION THROUGH STAIR STRINGER
SCALE: 1"=1'-0"

DETAIL 4
SECTION @ TREAD AND STRINGER SECUREMENT
SCALE: 1"=1'-0"

GENERAL NOTES
1. BRICK TO BE COMPRESSIVE STRENGTH OF 15 MPa (2200 psi) MIN. UNITS TO BE LAID WITH FULL HEAD AND BED JOINTS.
2. MORTAR TO BE TYPE S WITH JOINT THICKNESS OF 10mm (3/8") MIN. AND 20mm (3/4") MAX.
3. ALL NAILS AND SCREWS TO BE GALVANIZED.
4. WOOD FOR CANTILEVERED PICKETS SHALL BE DOUGLAS FIR-LARCH, SPRUCE-PINE-FIR, OR HEM-FIR SPECIES.



FOR STRUCTURE ONLY
FEB 03 2021

2012 CODE

COMPLIANCE PACKAGE "A1"



PROJECT NAME
RUSSELL GARDENS III

NO.	REVISIONS	DATE
1.	REVISED FOR STARTIME	NOV 16

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION
Required unless design is exempt under Division C, Subsection 2.2.5 of the building code

VIKAS GAJAR
NAME
28770
BCIN


REGION DESIGN INC.
2700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4G5
P (416) 736-4096
F (905) 560-0746

REGION DESIGN INC.

WOOD DECK DETAIL
SCALE: AS SHOWN
DATE: NOV 2016
TYPE: TYPE

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.

AREA: AREA
PAGE NO.: 8
PROJECT: 00-00-00

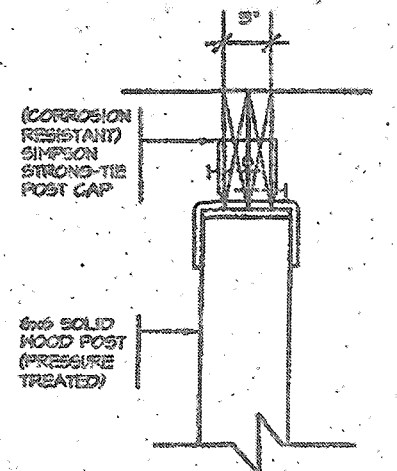

**DETAIL 2 -
BEAM-TO-POST**
SCALE: 1" = 1'-0"

2x2 PICKETS CHAMFERED AT
BOTTOM WITH 2x6 TOP CAP AND
2x4 TOP RAIL
(REFER TO DETAIL 1)

3'-6" HIGH WOOD RAILING IF
DECK FLOOR IS MORE THAN
5'-11" ABOVE GRADE AND 3'-0"
HIGH WOOD RAILING IF DECK IS
LESS THAN 5'-11" ABOVE GRADE

MAX. 4" OPENING BETWEEN
PICKETS



5/4x6 (PRESSURE TREATED)
DECKING WITH 1/4" GAP

DOUBLE RIM JOISTS (PRESSURE
TREATED)

WOOD BEAM AS PER PLAN
(PRESSURE TREATED)

(CORROSION RESISTANT)
SIMPSON STRONG-TIE POST CAP

(CORROSION RESISTANT)
SIMPSON STRONG-TIE COLUMN
BASE, 1/2" DIA. ANCHOR
BOLT.

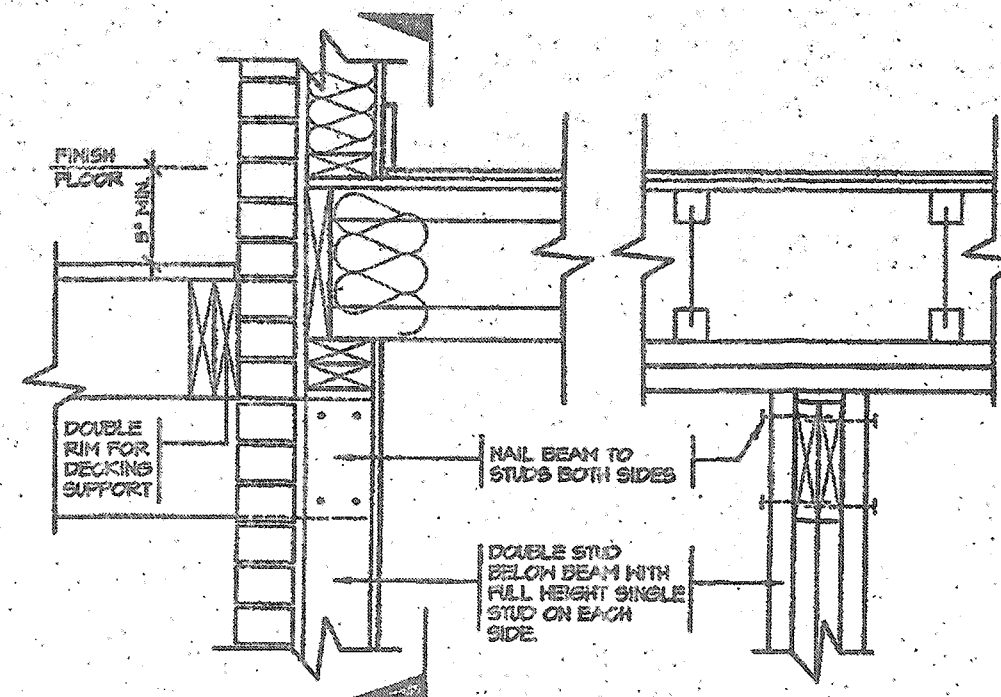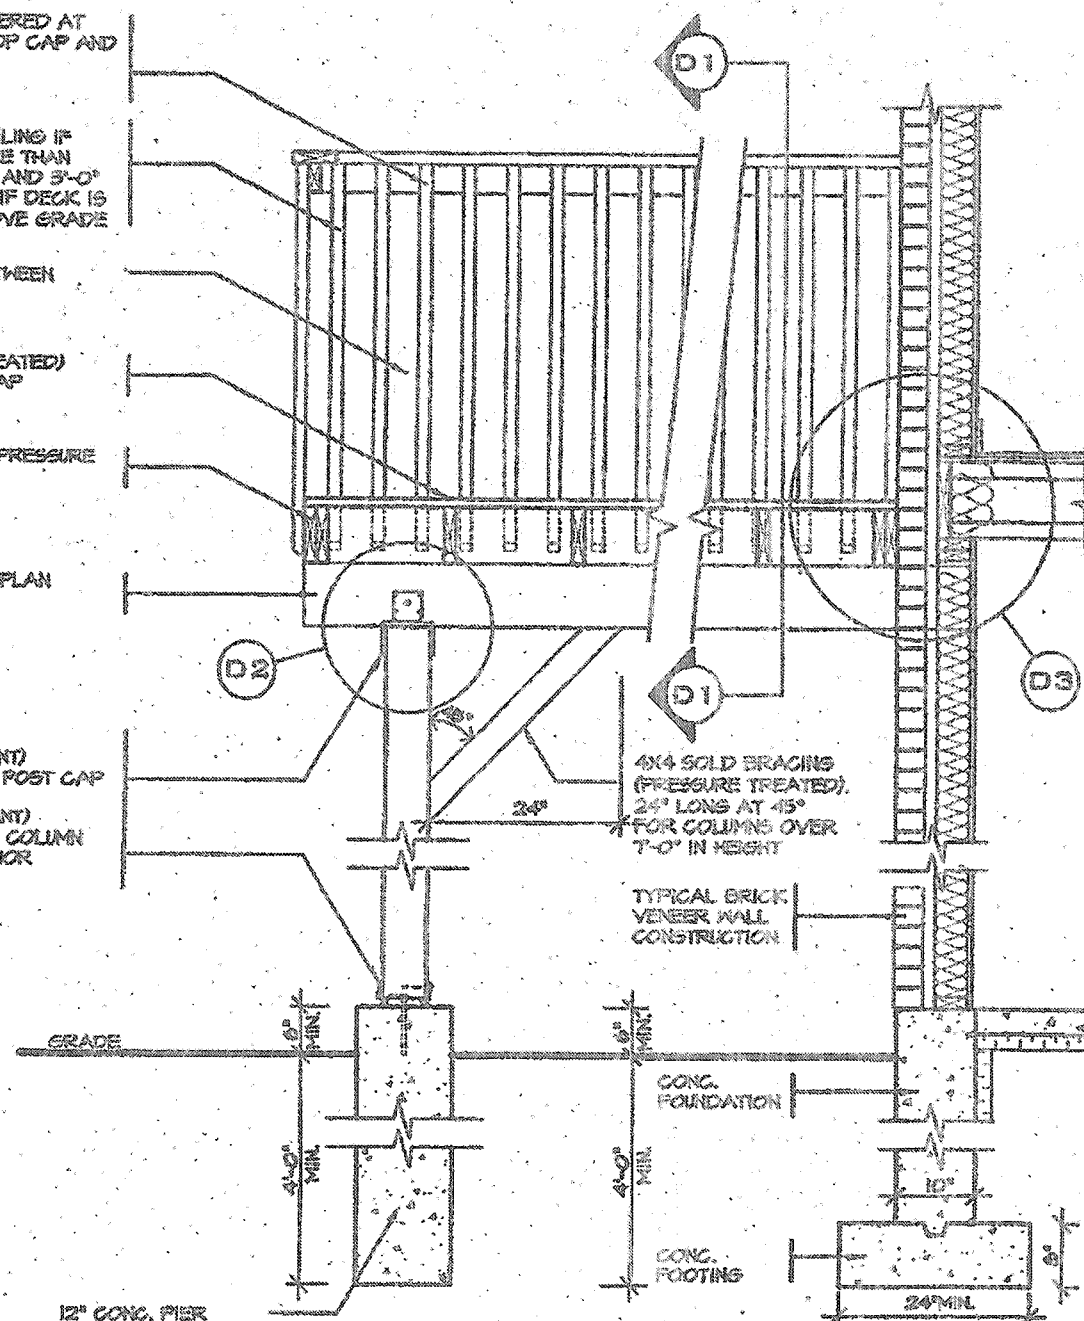

**DETAIL 3 -
BEAM-TO-STUD WALL**
SCALE: 1" = 1'-0"

DECK SECTION WITH BRICK VENEER

SCALE: 1/2" = 1'-0"

CITY OF HAMILTON
Building Division

Permit No. **Z** 107147

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by
FEB 23 2017


FOR CHIEF BUILDING OFFICIAL DATE

DETAIL 1

CANTILEVERED PICKET SCREWED TO RIM JOIST AND DECK


GUARD PARALLEL TO FLOOR JOISTS

SCALE: 1" = 1'-0"

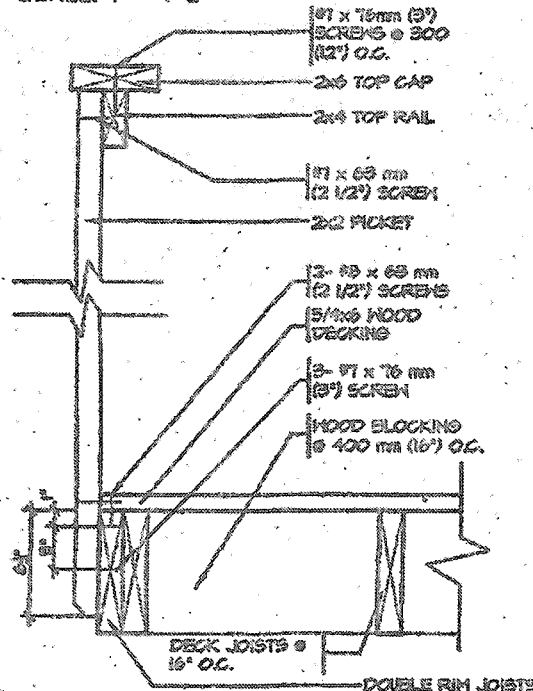

GUARD PERPENDICULAR TO FLOOR JOISTS

SCALE: 1" = 1'-0"

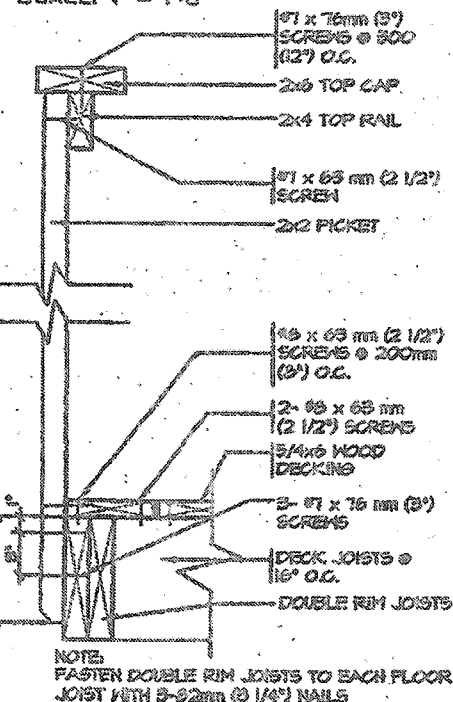

GENERAL NOTES


1. THE DECK HAS BEEN DESIGNED TO SAFELY SUPPORT A SUPERIMPOSED LOAD OF 1.4kPa (40psf)
2. ALL NAILS AND SCREWS TO BE GALVANIZED
3. WOOD FOR CANTILEVERED PICKETS SHALL BE DOUGLAS FIR-LARCH, SPRUCE-PINE-FIR, OR RED-PINE SPECIES
4. CONCRETE SHALL HAVE COMPRESSIVE STRENGTH OF 20MPa AT 28 DAYS AND 5-8% AIR ENTRAINMENT
5. FOOTINGS TO BE PLACED ON UNDISTURBED SOIL WITH MIN. BEARING PRESSURE OF 150kPa (3150psf)

MAR 03 2018



FOR STRUCTURE ONLY
2012 CODE

COMPLIANCE PACKAGE "A1"


5. _____ 4. _____ 3. _____ 2. _____ 1. REVISED FOR RUSSELL GARDENS MAR 2018 REVISIONS	The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 3.2.5 of the building code VIKAS GAJAR NAME  SIGNATURE 28770 BCIN	REGION DESIGN INC. 8700 DUFFERIN ST. CONCORD, ONTARIO L4K 4S0 P (416) 736-4095 F (905) 600-0743	REGION DESIGN INC.	SHEET TITLE WALK-OUT DECK DETAILS SCALE AS SHOWN BY DATE MAR 2018 TYPE	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED. AREA PROJECT 00-00-00 PAGE No. 8-2	 Greenpark. PROJECT NAME RUSSELL GARDENS III
--	---	--	----------------------------------	---	--	---

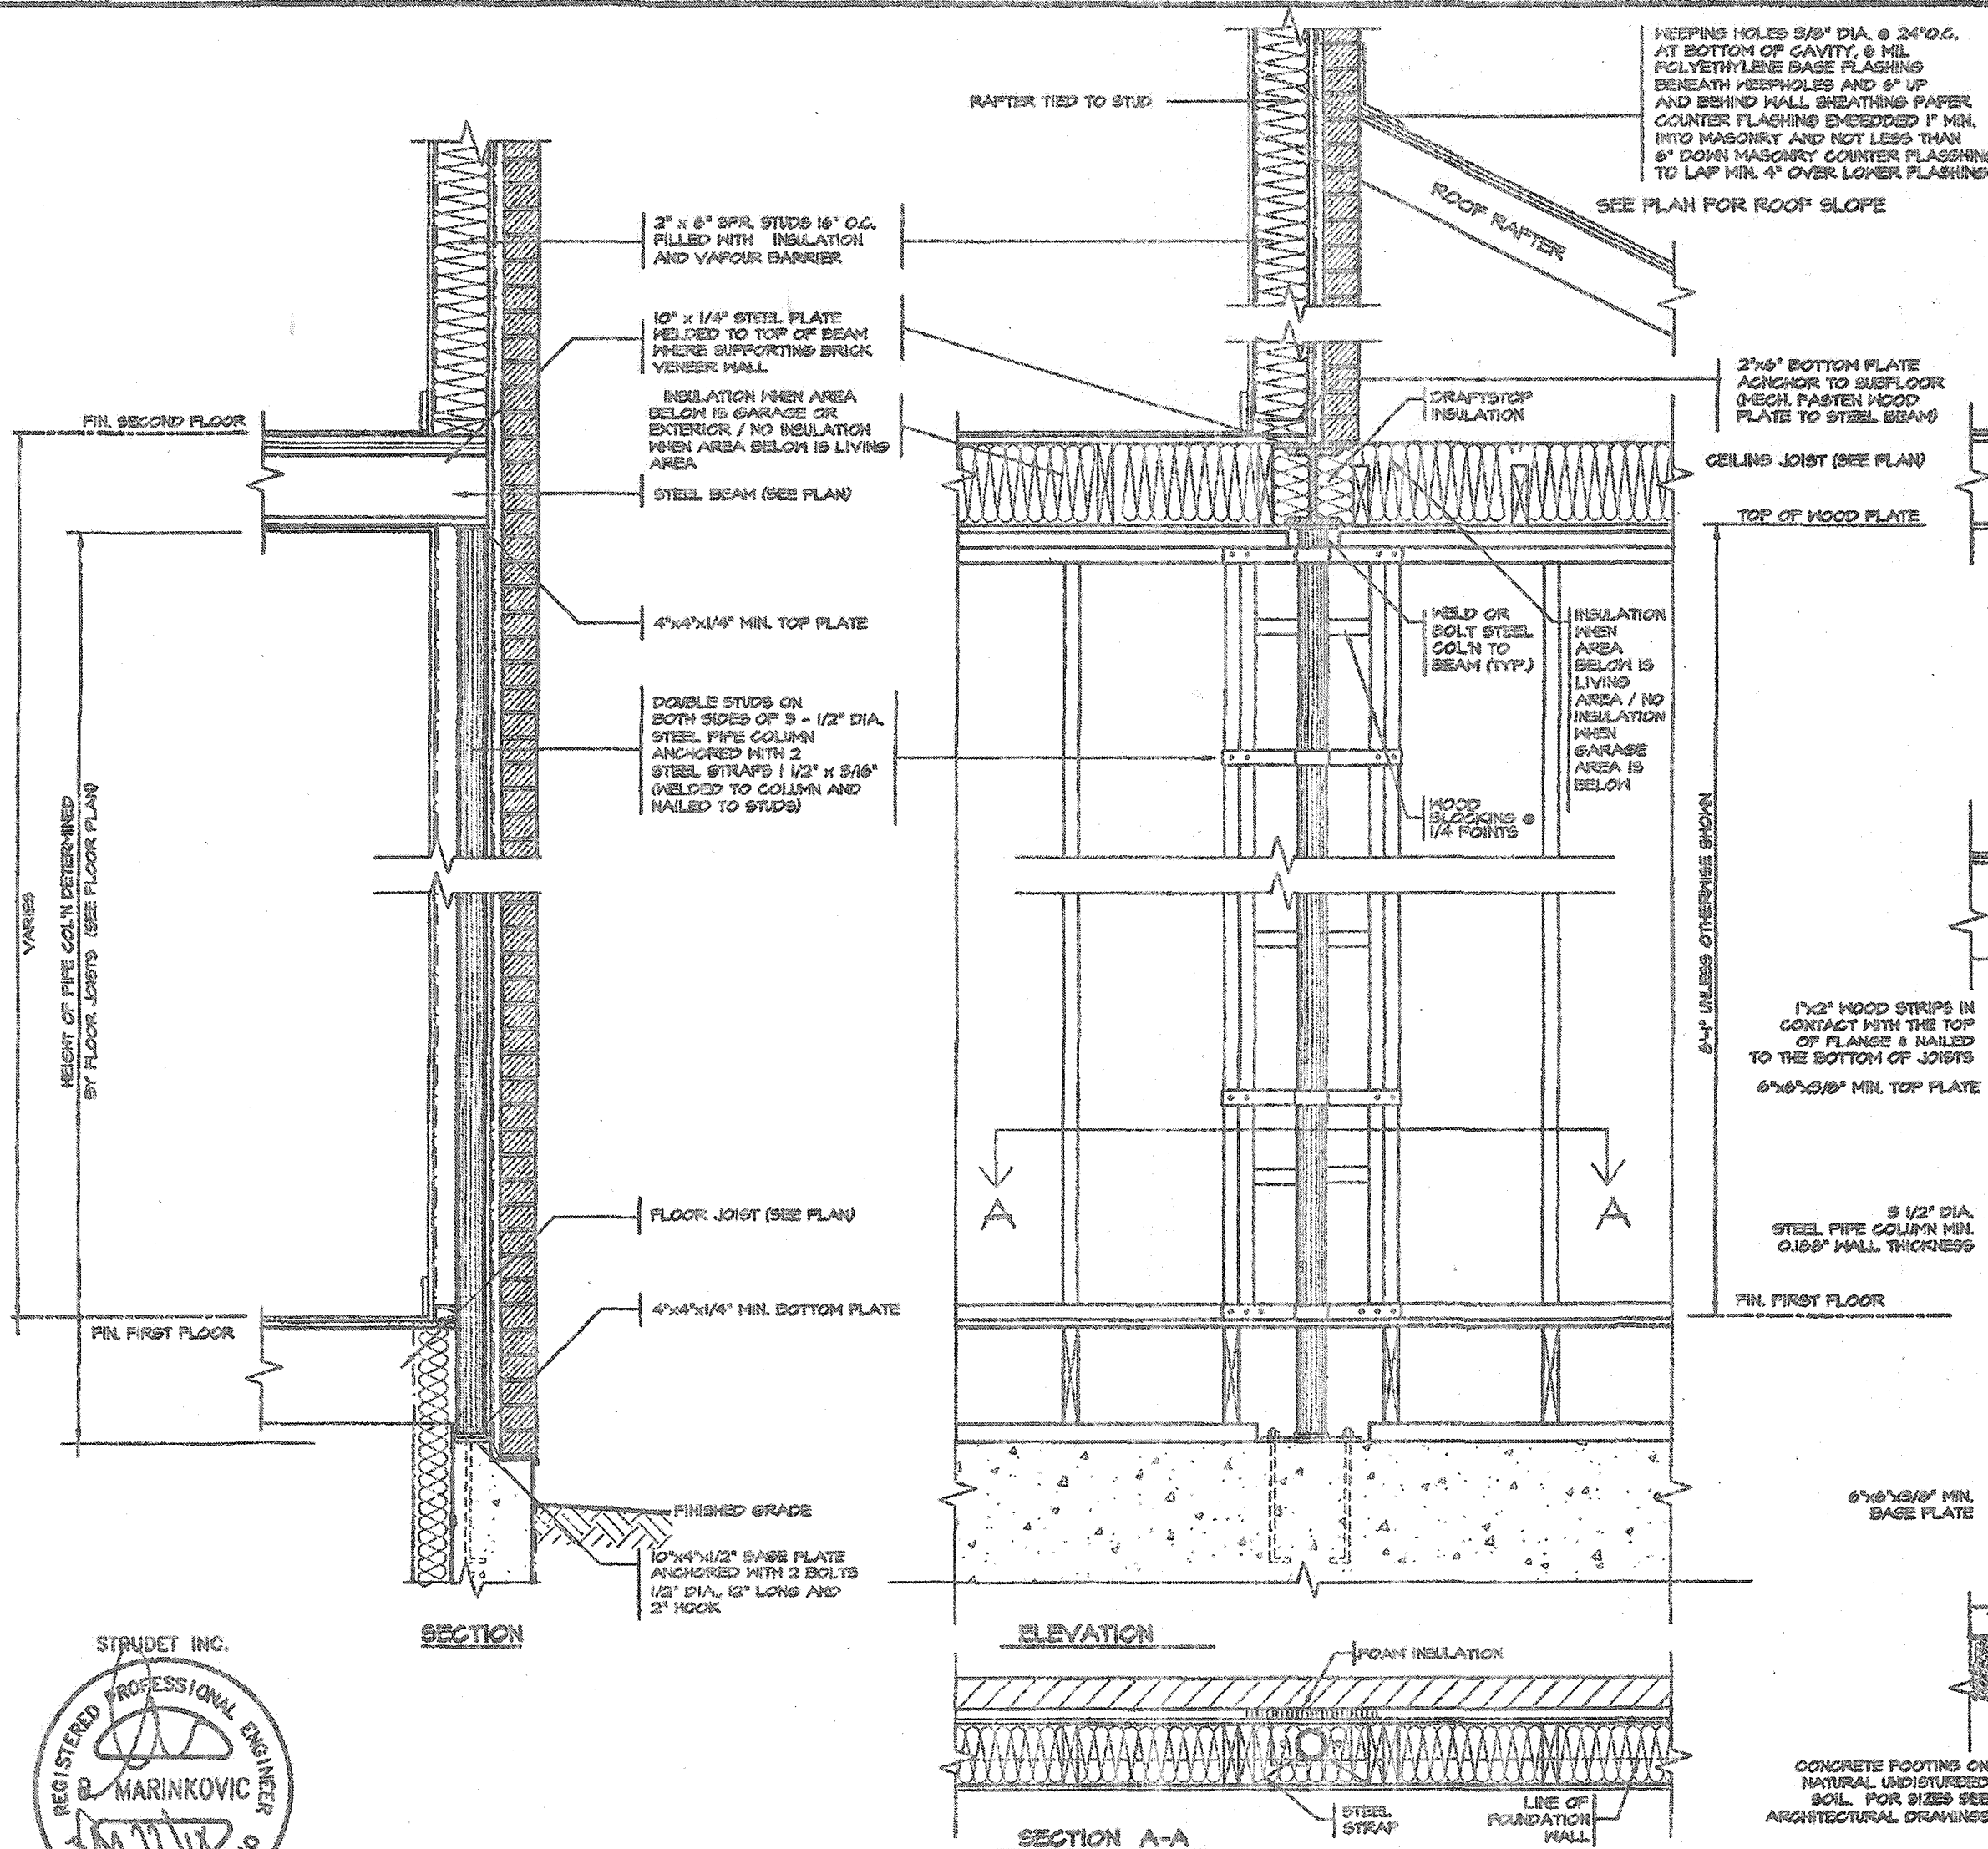


**SECTION THROUGH STEEL BEAM
SUPPORTING MASONRY & BEARING
STUD PARTITION**

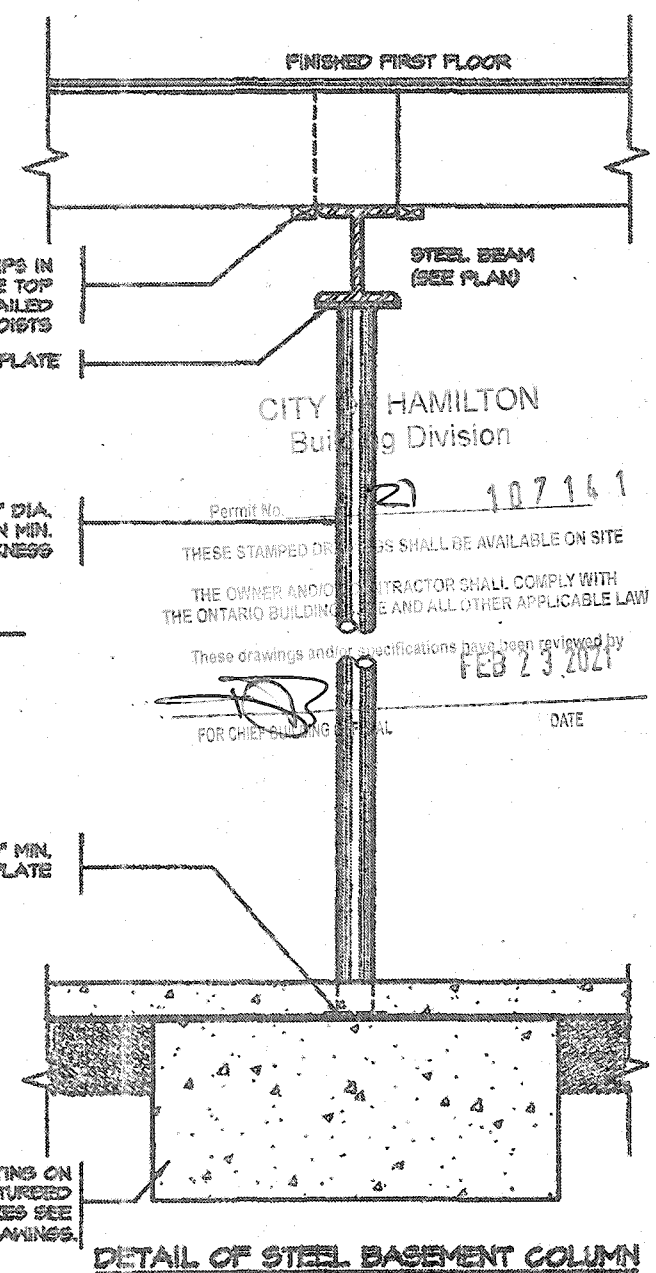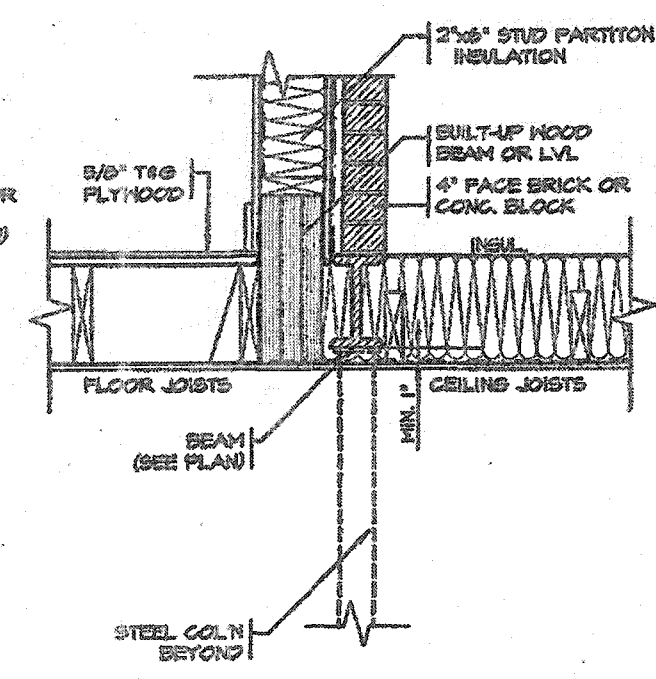

**2012 CODE
COMPLIANCE PACKAGE "A1"**

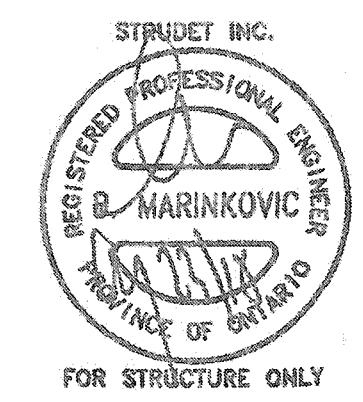


5. 4. 3. 2. 1. ISSUED FOR PERMIT REVISIONS JUL 30, 2018	The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 3.2.5 of the building code VIKAS GAJJAR NAME SIGNATURE 28770 BCIN	REGION DESIGN INC. 8700 DUFFERIN ST. CONCORD, ONTARIO L4K 4S6 P (416) 736-4000 F (905) 680-0746 REGION DESIGN INC.	SHEET TITLE COLUMN DETAILS STEEL SCALE 3/4"=1'-0" DATE JULY 2018	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED. PAGE No. 9	Greenpark. PROJECT NAME RUSSELL GARDENS III
--	--	---	---	--	---

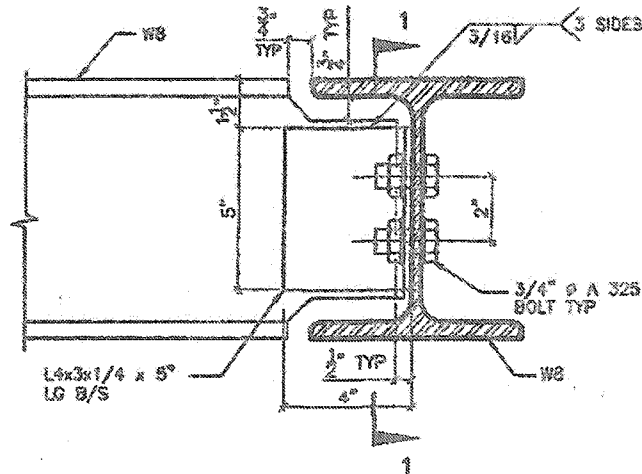


DETAIL 1.

W8
TO
W8
CONNECTION

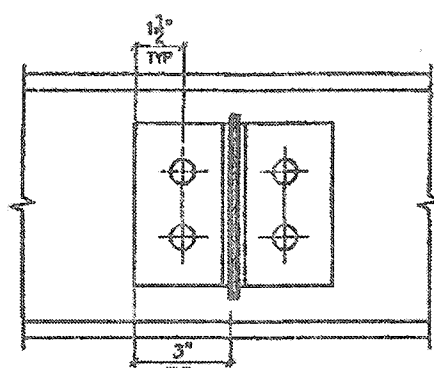


SECTION 1-1

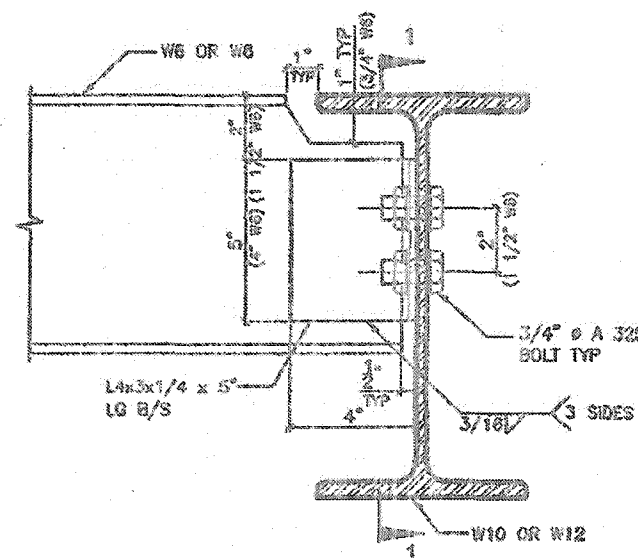


DETAIL 2.

W6(W8)
TO
W10(W12)
CONNECTION

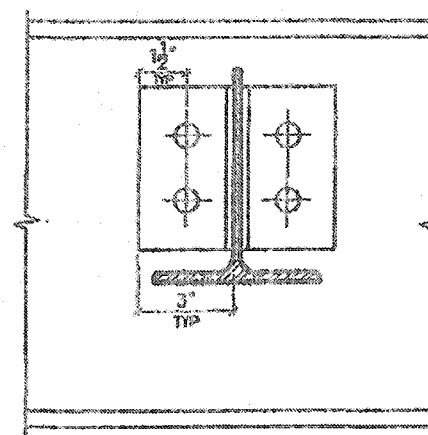


SECTION 1-1

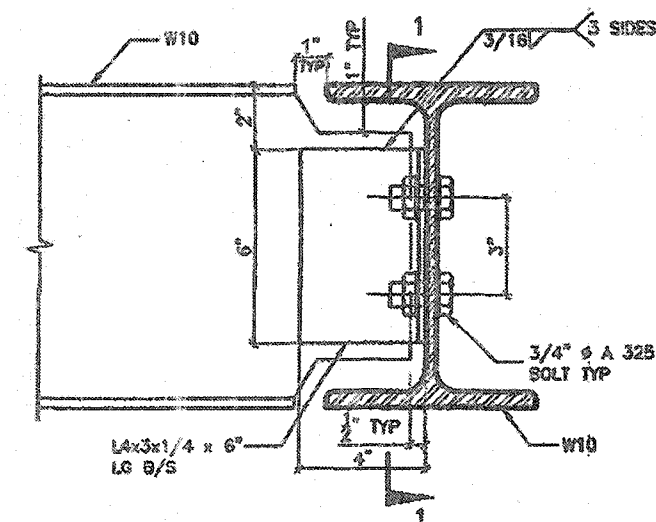


DETAIL 3.

W10
TO
W10
CONNECTION

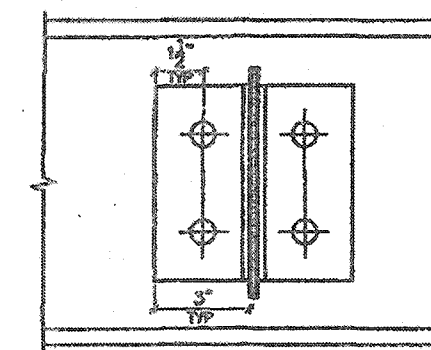


SECTION 1-1

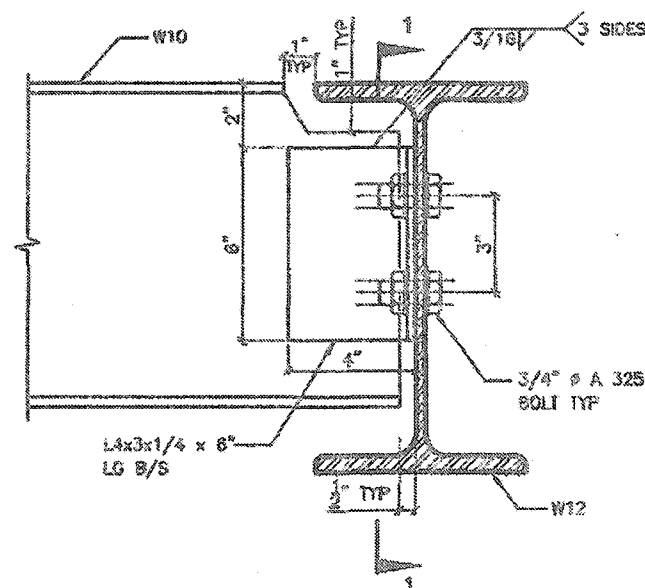


DETAIL 4.

W10
TO
W12
CONNECTION

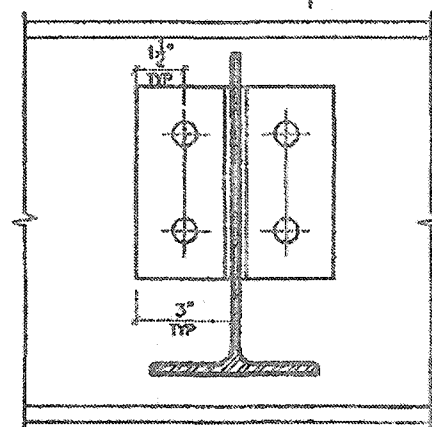


SECTION 1-1

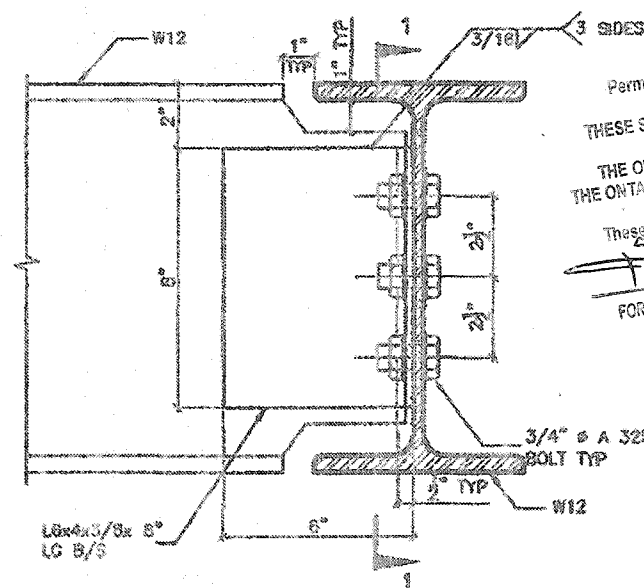

DETAIL 5.

W12
TO
W12
CONNECTION

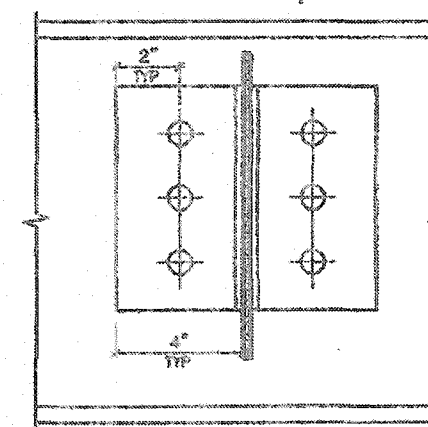


SECTION 1-1

CITY OF HAMILTON
Building Division
Permit No. 21 107141
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE CODES
These drawings and/or specifications have been reviewed by
FEB 23 2021
DATE
FOR CHIEF BUILDING OFFICIAL




DETAIL 6.

ANGLE
TO
BEAM
CONNECTION

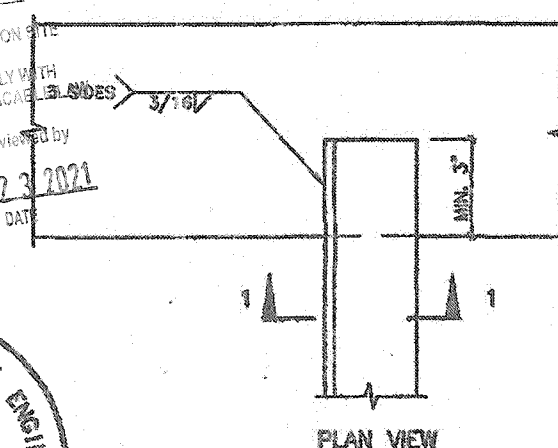

PLAN VIEW

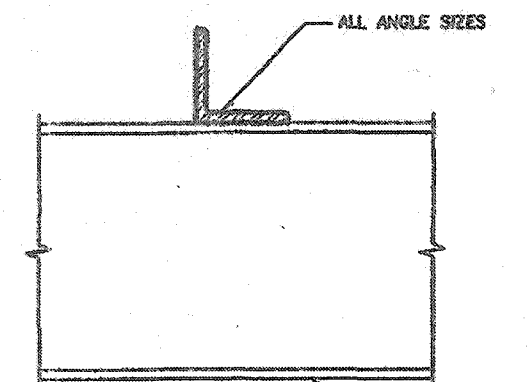

SECTION 1-1 ALL BEAM SIZES

2012 CODE
COMPLIANCE PACKAGE "A1"

5.	
4.	
3.	
2.	
1.	ISSUED FOR PERMIT
REVISIONS	

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.
QUALIFICATION INFORMATION
Required unless design is exempt under Division C, Subsection 3.2.6 of the building code
VIKAS GAJJAR
NAME
SIGNATURE
28770
BCIN


REGION DESIGN INC.
8700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S6
P (416) 736-1035
F (905) 660-0745

REGION
DESIGN
INC.


SHEET TITLE
BEAM DETAILS
STEEL
SCALE
N.T.S.
DATE
JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.
PAGE No.
10


Greenpark.
PROJECT NAME
RUSSELL GARDENS III

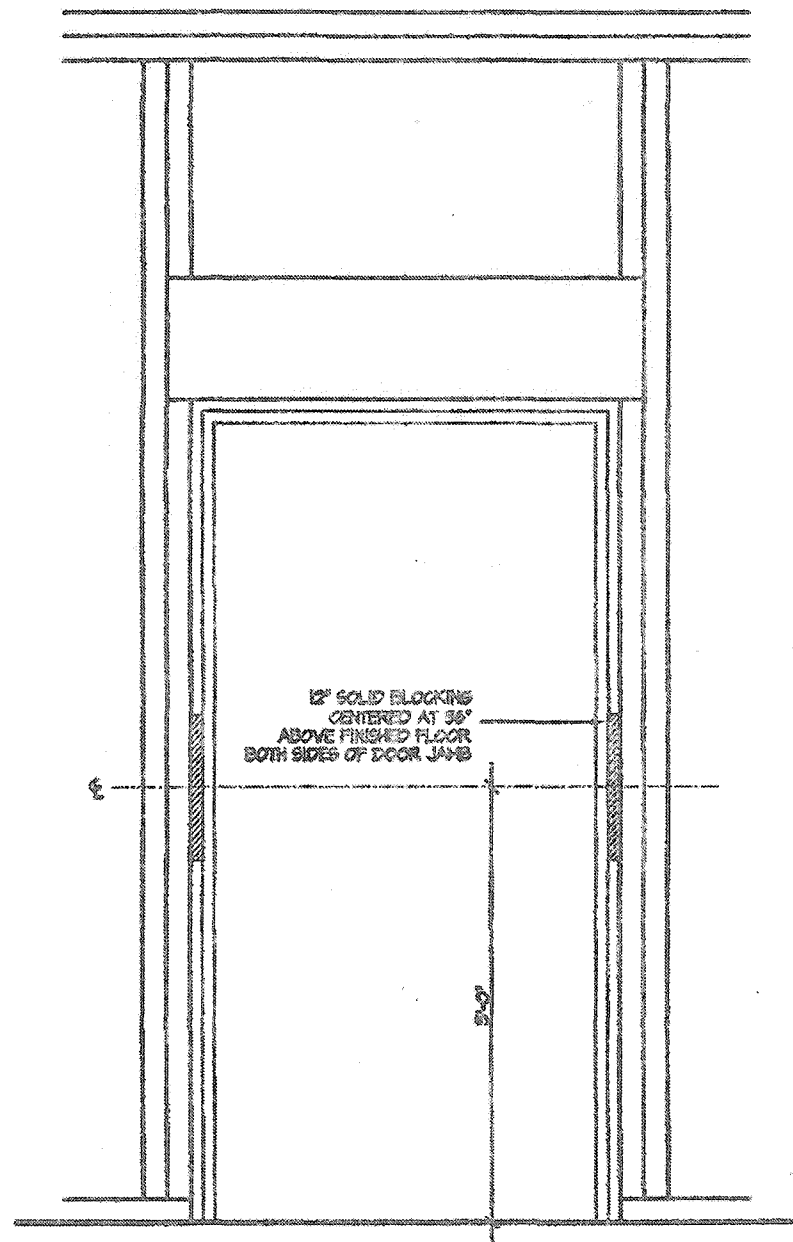


RESISTANCE TO FORCED ENTRY (OBC 9.6.2.)

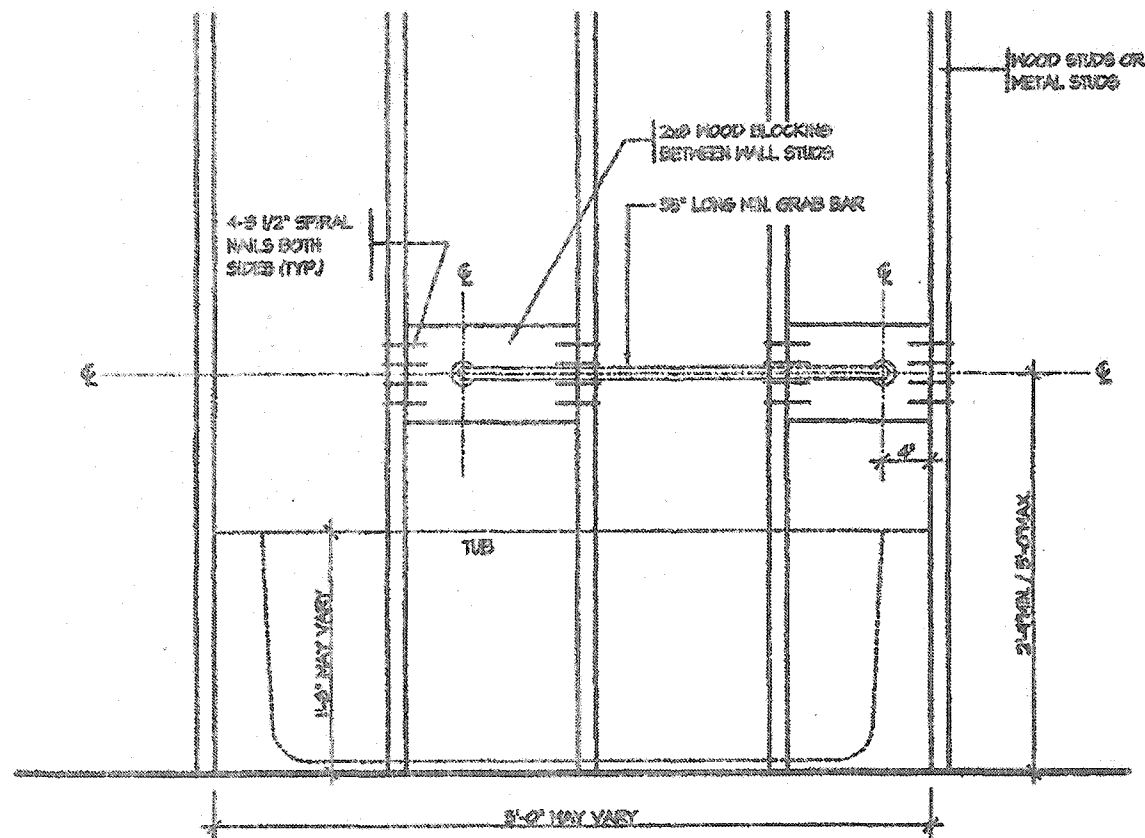

BATH TUB FRONT ELEVATION

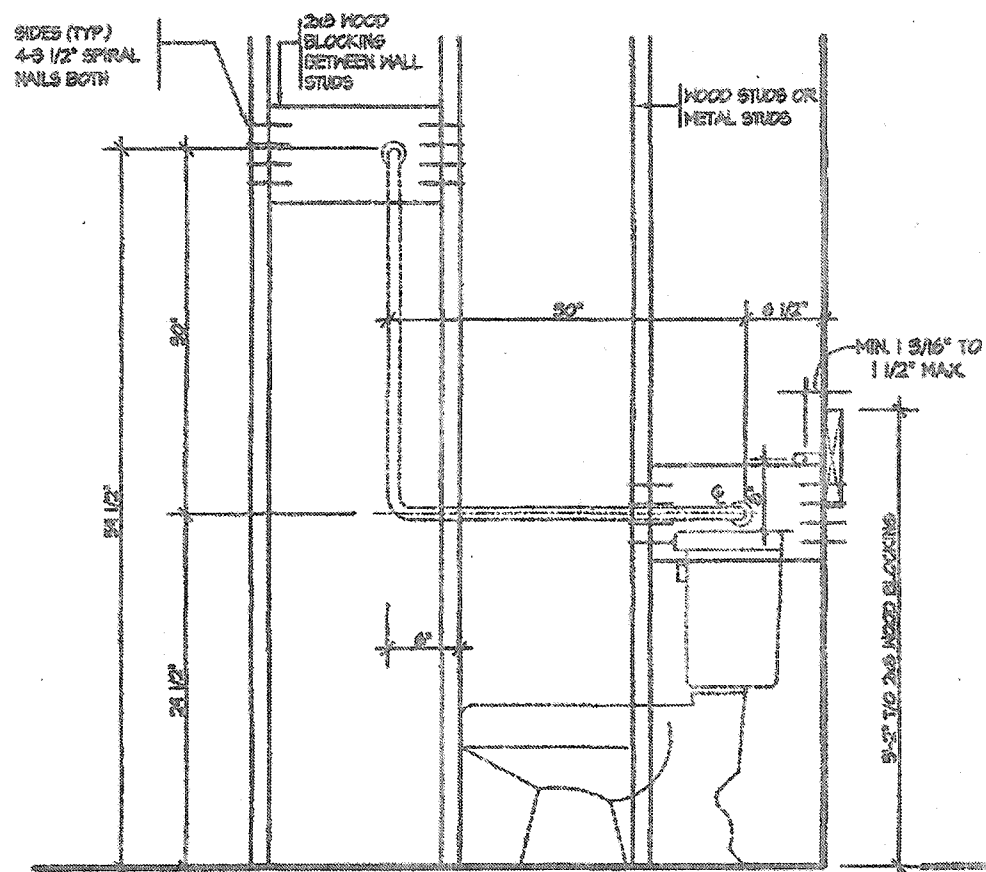

TOILET SIDE ELEVATION

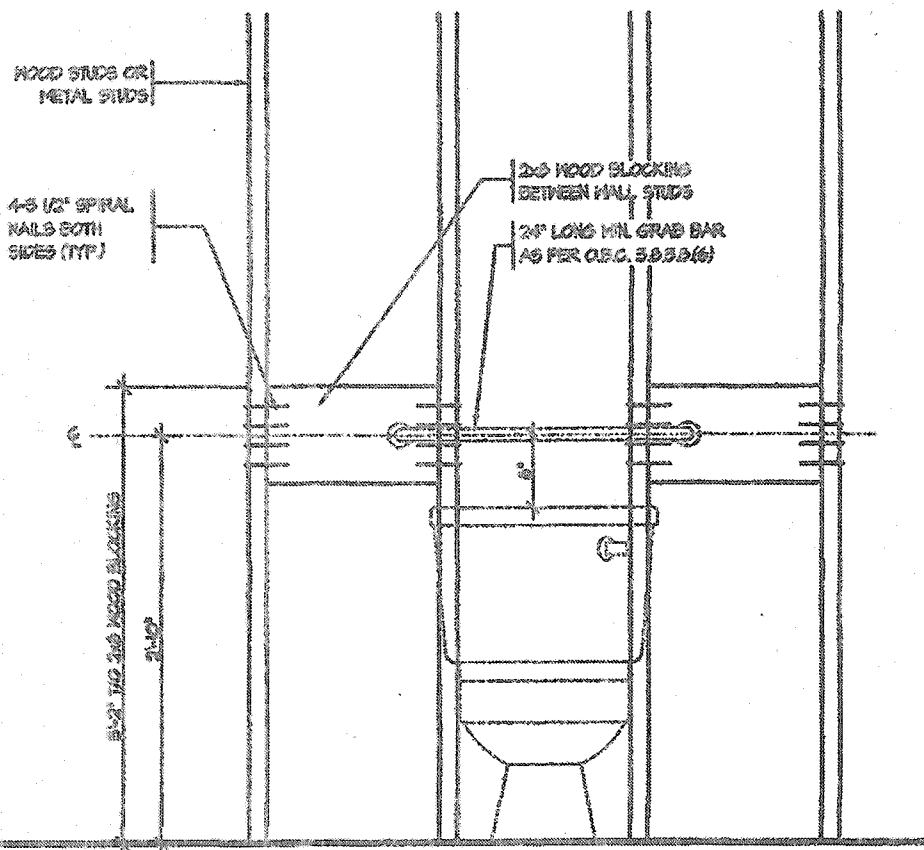

TOILET FRONT ELEVATION


STRUCTURAL REINFORCEMENT FOR GRAB BAR (OBC 9.5.2.3.)

CITY OF HAMILTON
Building Division

Permit No. 21 107 161


THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW


These drawings and/or specifications have been reviewed by
FOR CHIEF BUILDING OFFICIAL
DATE
FEB 23 2021

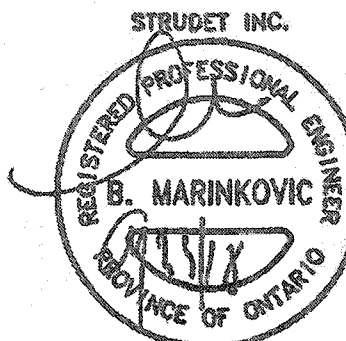

FOR STRUCTURE ONLY


2012 CODE
COMPLIANCE PACKAGE "A1"

5.		The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 3.2.5 of the building code VIKAS GAJJAR  28770 NAME SIGNATURE BCIN	REGION DESIGN INC. 6700 DUFFERIN ST. CONCORD, ONTARIO L4K 4G6 P (416) 736-4096 F (905) 660-0746	REGION DESIGN INC.	SHEET TITLE	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.	PAGE No. 11	PROJECT NAME RUSSELL GARDENS III
4.					BLOCKING			
3.					FORCED ENTRY & GRAB BAR			
2.					SCALE			
1.	ISSUED FOR PERMIT				3/4"=1'-0"			
REVISIONS		JUL 30, 2018						

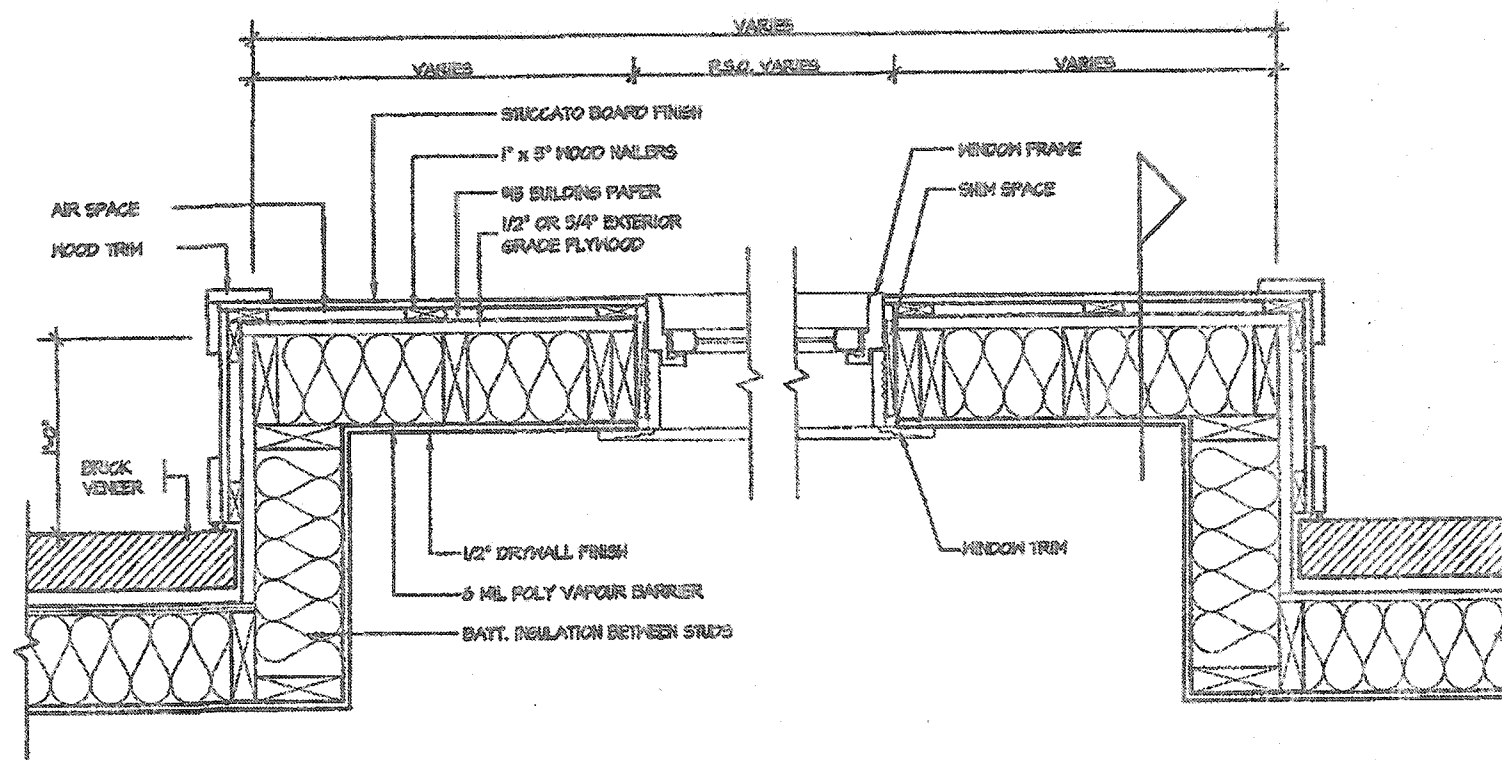

PLAN VIEW

STUCCATO BOARD FINISH CLADDING (OBC 9.2.1)

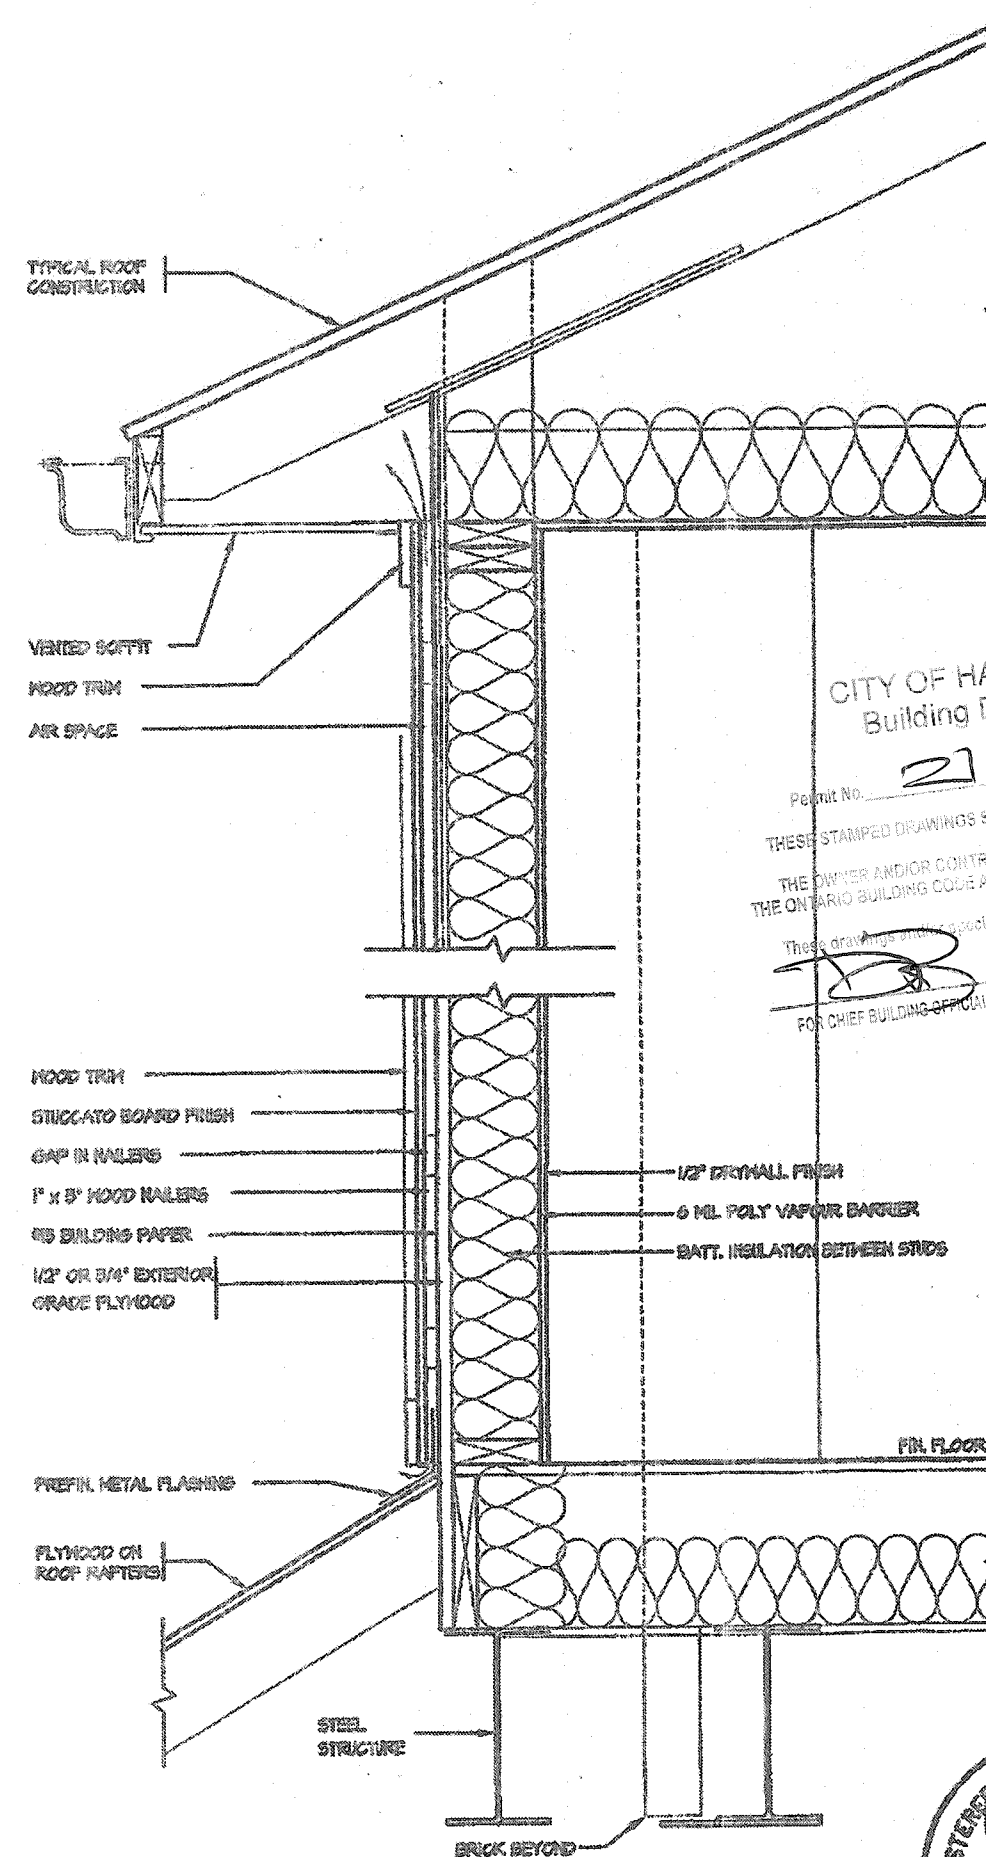

CROSS SECTION





CITY OF HAMILTON
Building Division
Permit No. **21 107161**
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and specifications have been reviewed by
FEB 23 2021
DATE
FOR CHIEF BUILDING OFFICIAL



FOR STRUCTURE ONLY

2012 CODE
COMPLIANCE PACKAGE "A1"

5. 4. 3. 2. 1. ISSUED FOR PERMIT REVISIONS JUL 30, 2018	The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 3.2.5 of the building code VIKAS GAJJAR NAME SIGNATURE 28770 BCIN	REGION DESIGN INC. 8700 DUFFERIN ST. CONCORD, ONTARIO L4K 1S6 P (416) 739-4099 F (800) 560-0745	REGION DESIGN INC.	SHEET TITLE STUCCATO BOARD FINISH CLADDING SCALE 1/2"=1'-0" DATE JULY 2018	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED. PAGE No. 12	PROJECT NAME RUSSELL GARDENS III
--	--	--	--	---	---	---

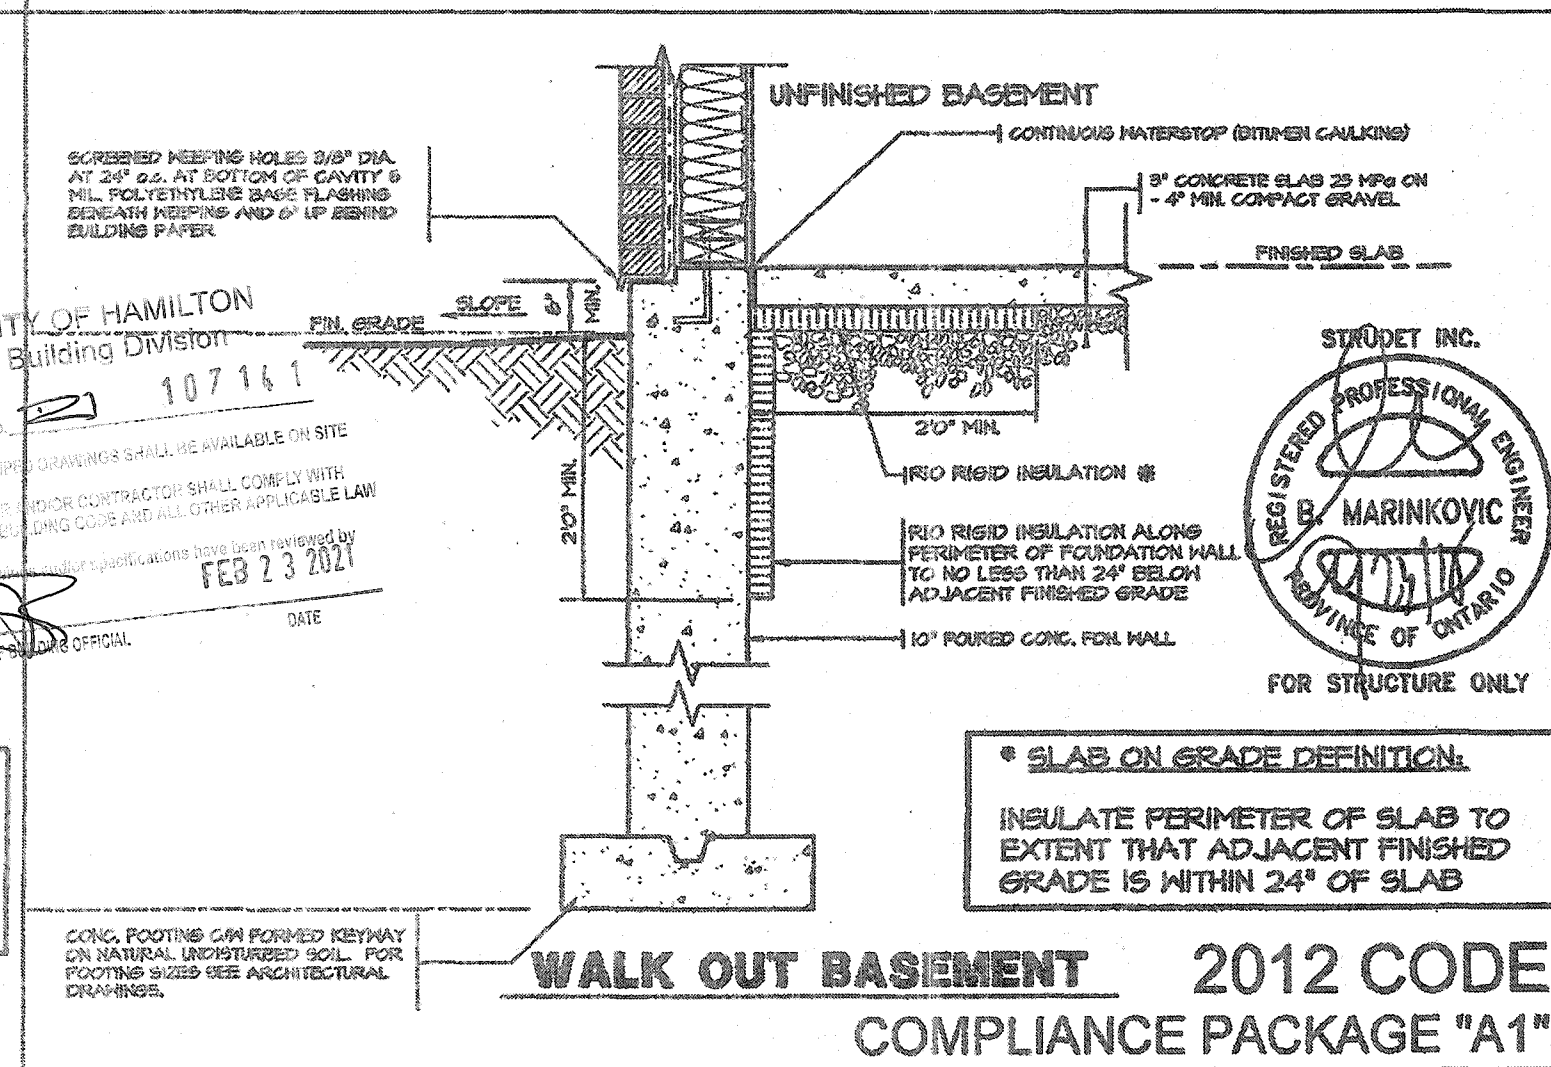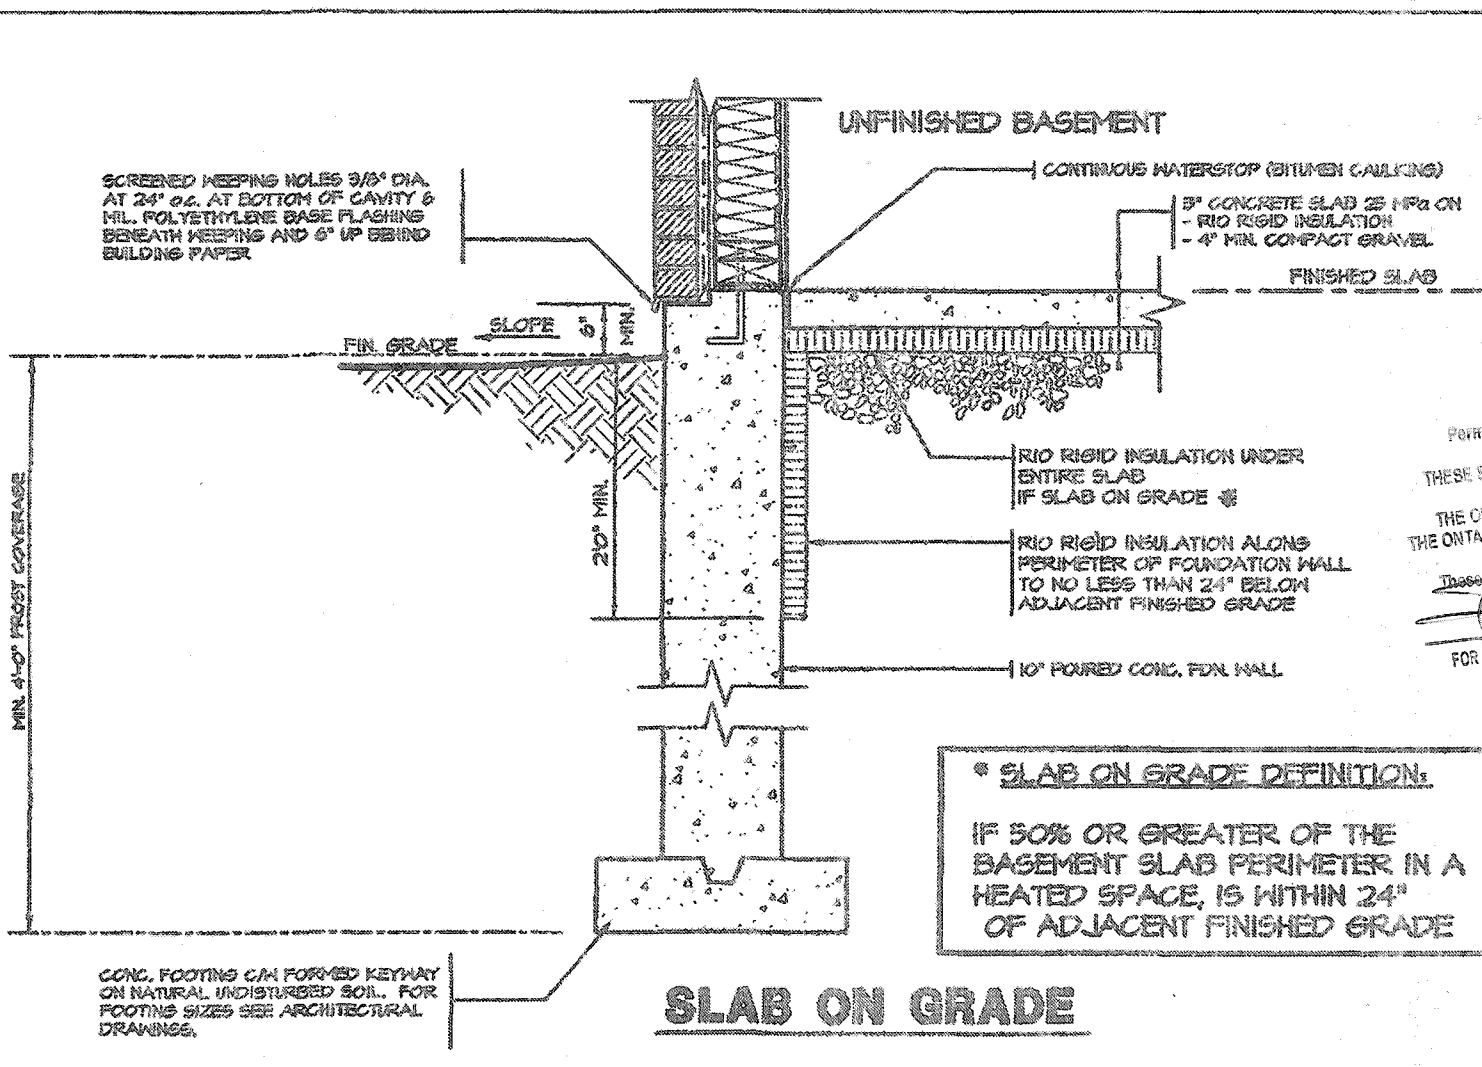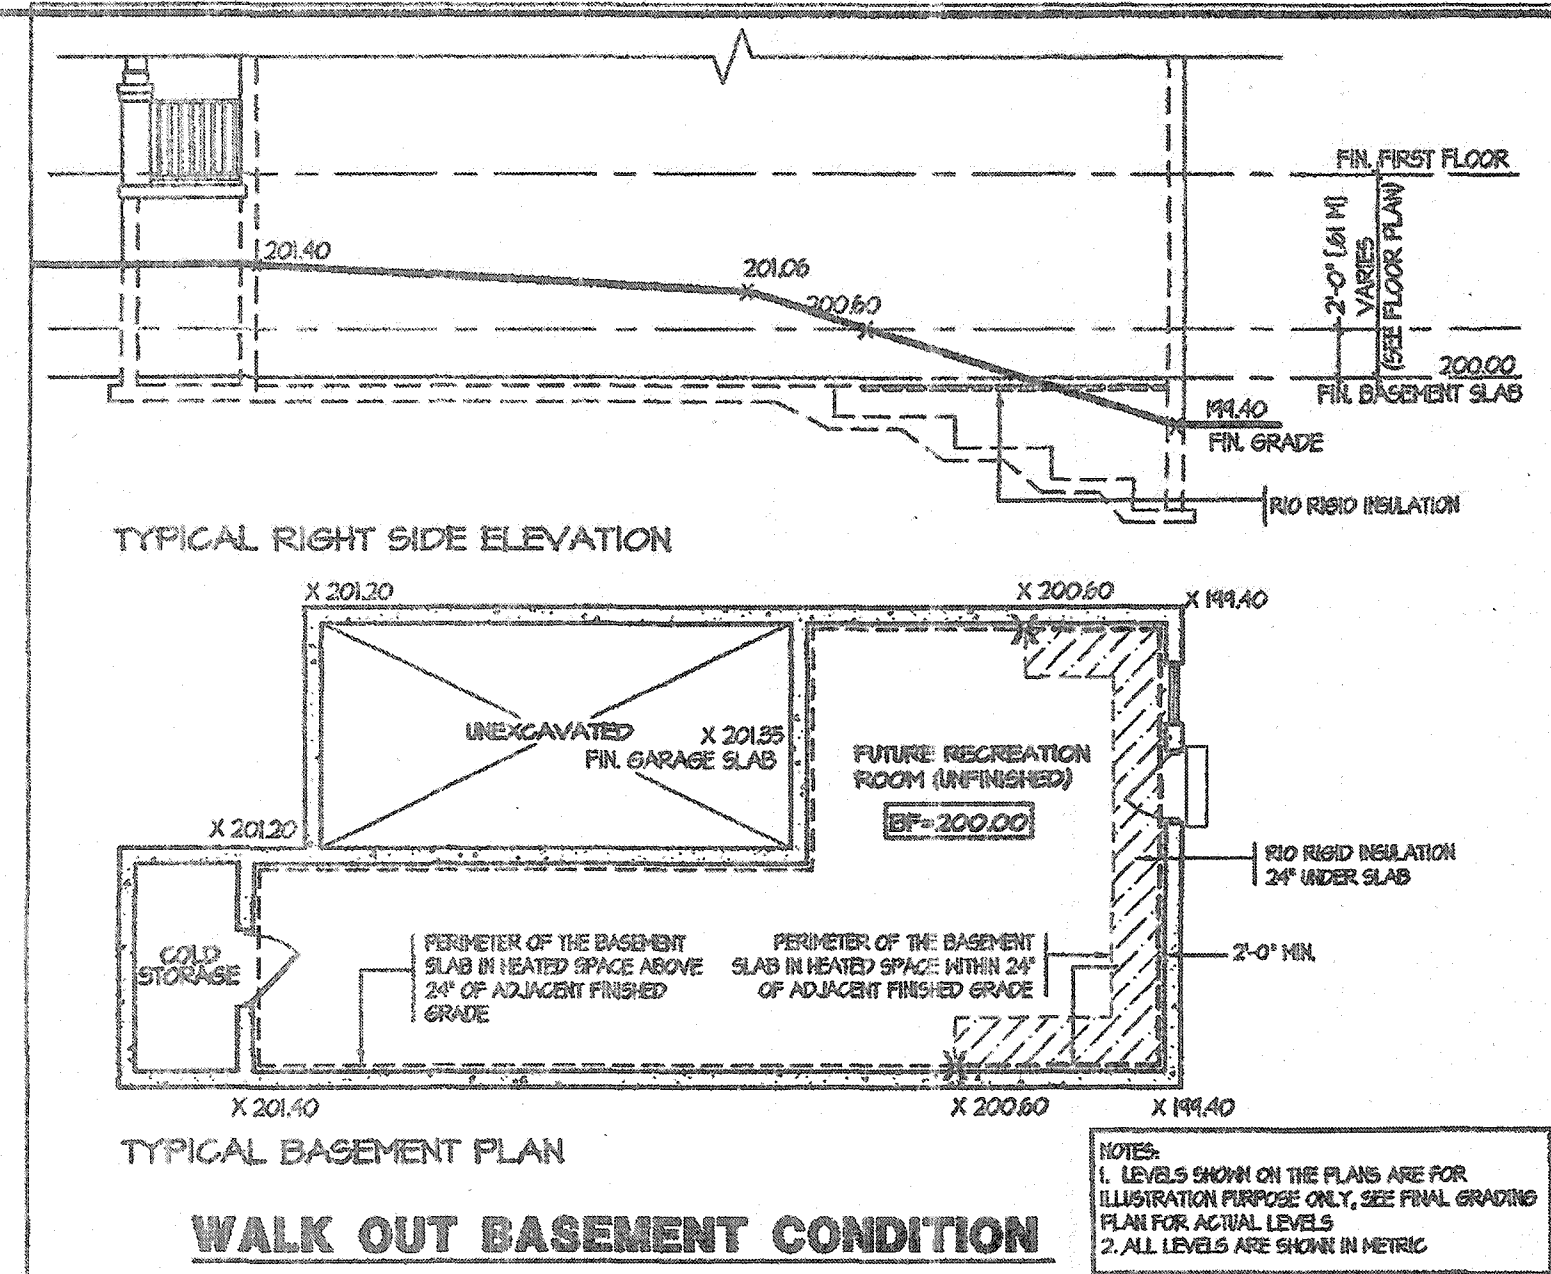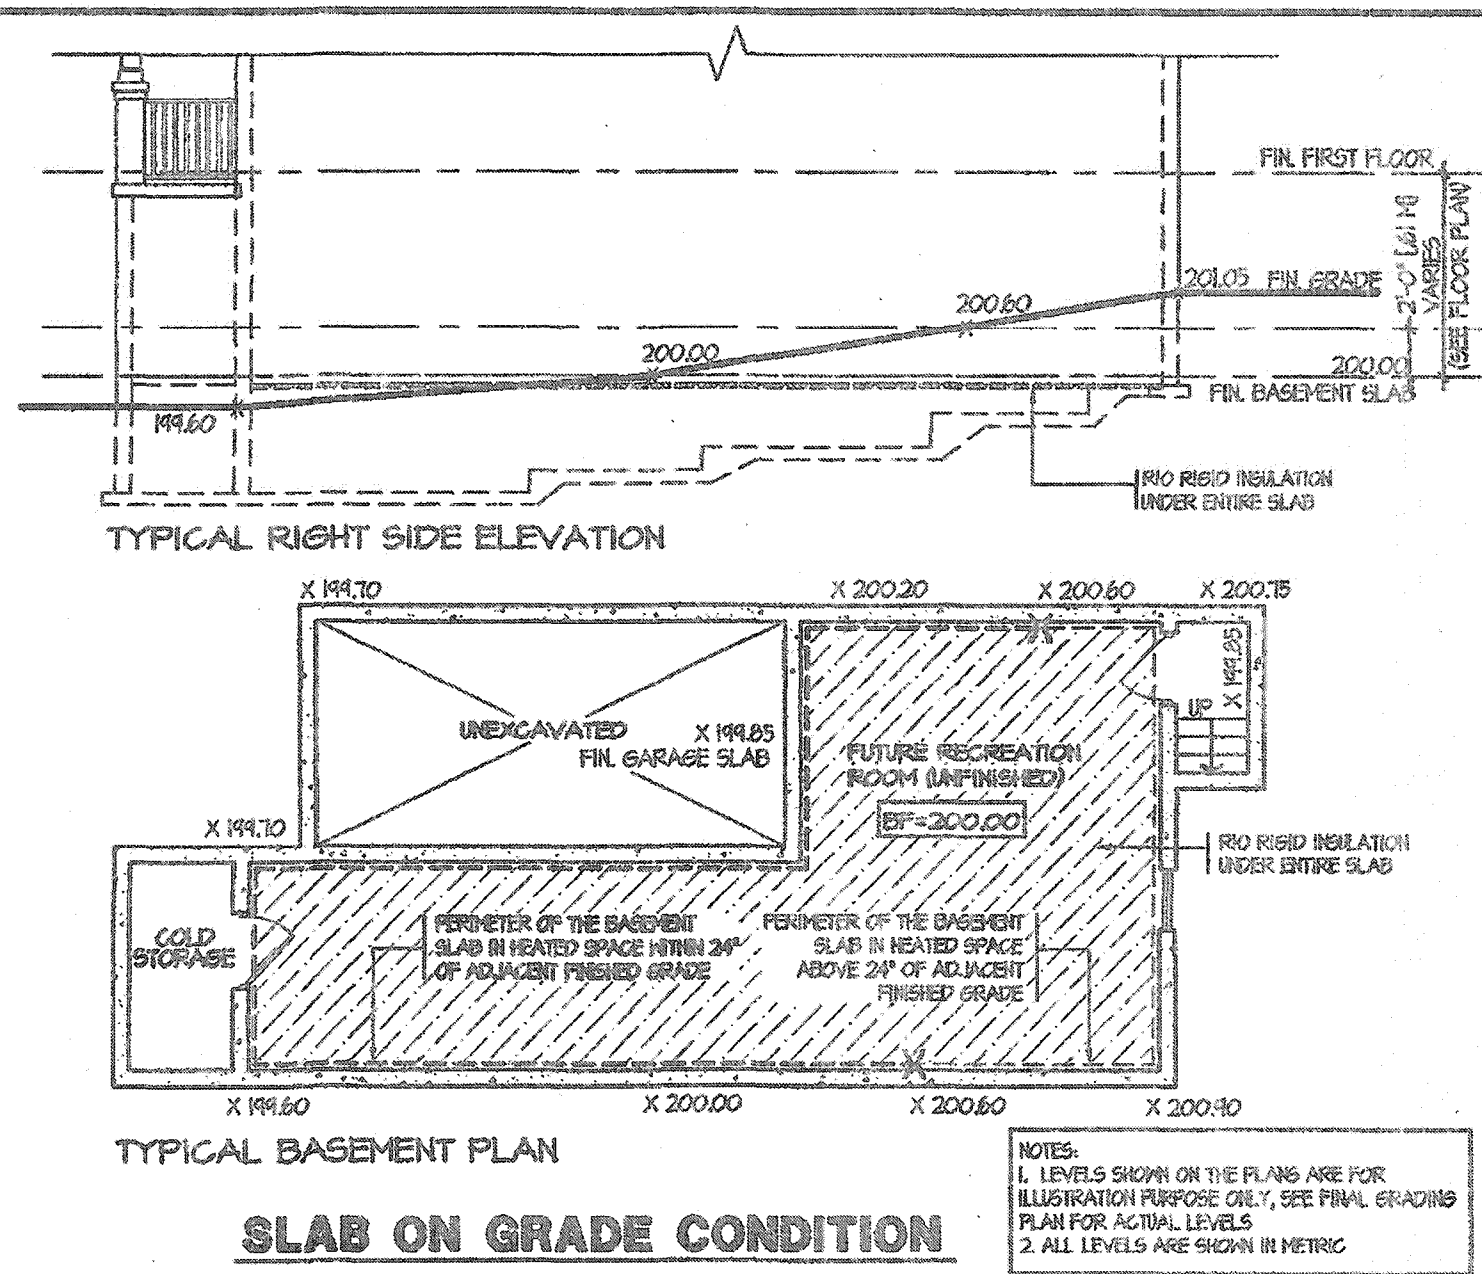

CITY OF HAMILTON
Building Division
107161
Permit No. 107161
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and specifications have been reviewed by
FEB 23 2021
DATE
FOR CHIEF BUILDING OFFICIAL

STUDET INC.
REGISTERED PROFESSIONAL ENGINEER
B. MARINKOVIC
PROVINCE OF ONTARIO
FOR STRUCTURE ONLY

NO.	REVISIONS	DATE
1.	ISSUED FOR PERMIT	JUL 30, 2018

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION
Required unless design is exempt under Division C, Subsection 3.2.5 of the building code

VIKAS GAJJAR
NAME
SIGNATURE
28770
BCIN

REGION DESIGN INC.
8700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S0
P (416) 738-4000
F (905) 660-0740


REGION DESIGN INC.

SHEET TITLE
**SLAB ON GRADE
WALKOUT BASEMENT**
SCALE
N.T.S.
DATE
JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.


PAGE No.
13

Greenpark.
PROJECT NAME
RUSSELL GARDENS III

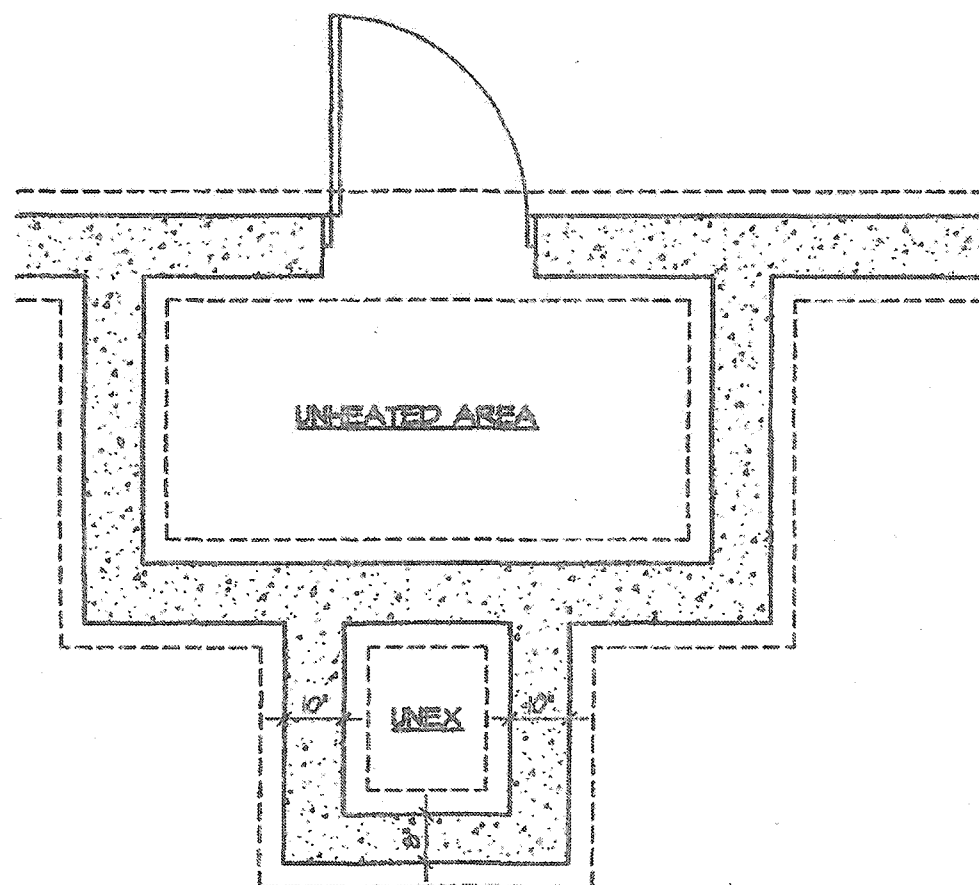


FOUNDATION PLAN

FOR POURED CONCRETE
SLAB STRUCTURE REFER
TO ARCHITECTURAL
DRAWINGS

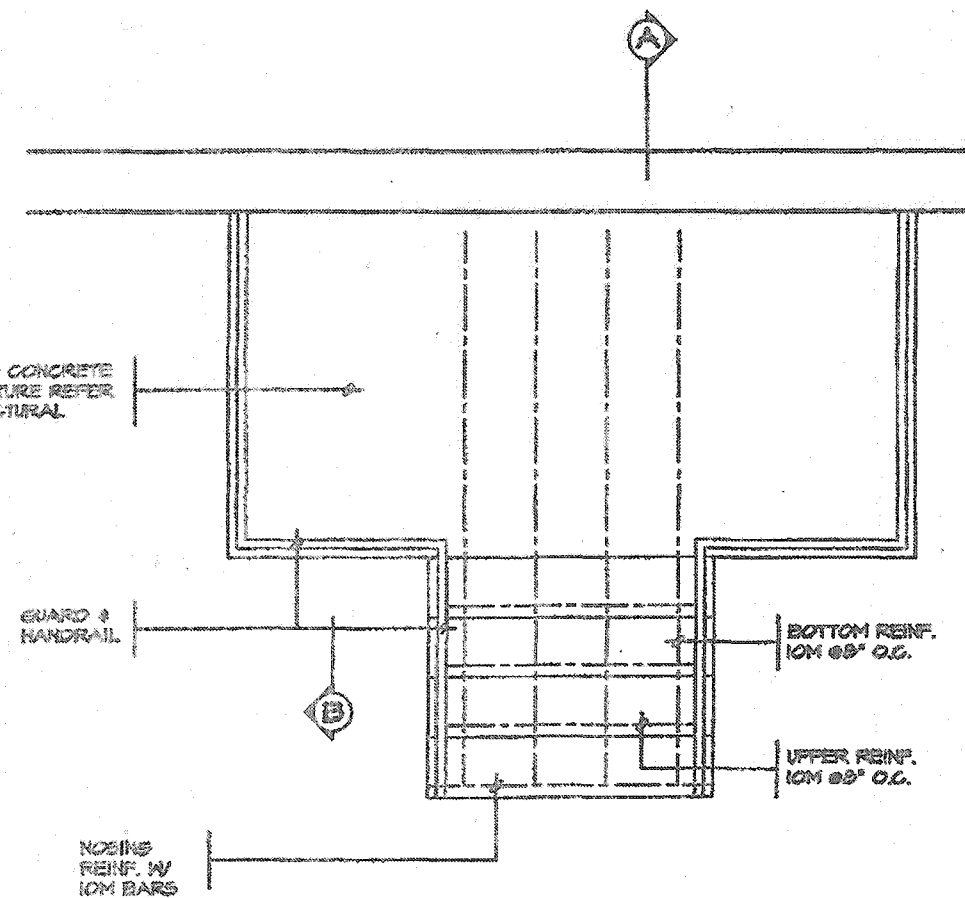

GROUND FLOOR PLAN

FOR POURED CONCRETE
SLAB STRUCTURE REFER
TO ARCHITECTURAL
DRAWINGS

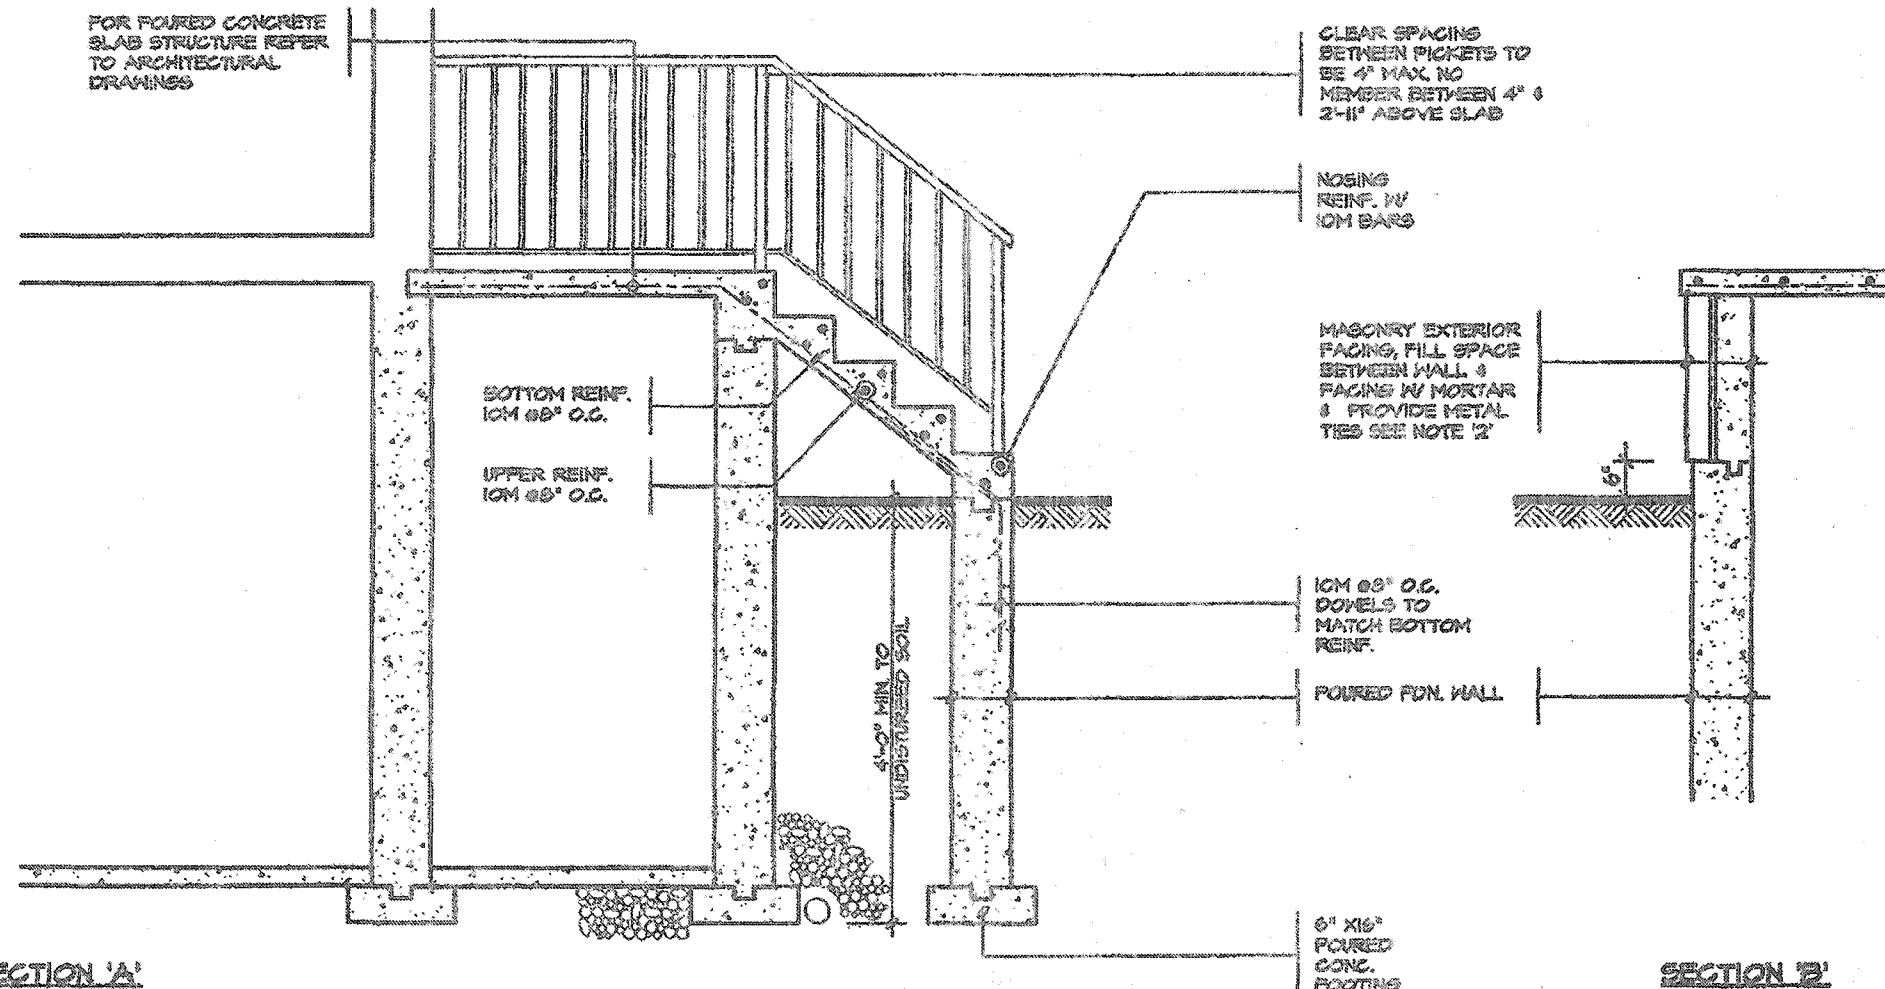

SECTION 'A'

SECTION 'B'

NOTE: FOR MORE THAN 8 RISERS


GENERAL NOTES

- EXTERIOR STAIRS**
1 1/8" RISE MAXIMUM
8 1/4" RUN MINIMUM
9 1/4" TREAD MINIMUM
- MASONRY TIES**
WHEN BRICK FACING IS USED ABOVE
GROUND LEVEL, PROVIDE 3/16" DIA.
CORROSION RESISTANT METAL TIES @ 36"
HORIZONTAL & 9" VERTICAL
- GUARDS**
ARE REQUIRED AROUND CONCRETE SLAB
IF MORE THAN 2'-0" ABOVE GRADE & ON
BOTH SIDES OF STAIRS CONTAINING MORE
THAN 6 RISERS. MINIMUM 31" HIGH FOR
STAIRS MINIMUM 36" HIGH FOR PORCHES
UP TO 5'-11" ABOVE GRADE. MINIMUM 42"
HIGH FOR GREATER HTS.
- HANDRAIL**
ARE REQUIRED WHERE STAIRS HAVE MORE
THAN 3 RISERS. HANDRAIL HEIGHT 31" -
36"
- FOUNDATION WALLS**
THICKNESS OF FOUNDATION WALLS IS
DEPENDANT UPON VENEER CUT 3" FOR UP
TO 26" VENEER CUT HEIGHT 10" FOR
VENEER CUT OVER 26" HIGH
- CONCRETE**
MINIMUM CONCRETE STRENGTH SHALL BE
4000 PSI (28MPa) W/ 5% MAX AIR
ENTRAINMENT MINIMUM CONCRETE SLAB
THICKNESS 5"
- CONCRETE COVER**
PROVIDE MINIMUM 3/4" CLEAR CONCRETE
COVER TO REINFORCING BARS

CITY OF HAMILTON
Building Division

Permit No. 221 107111
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
[Signature] FEB 23 2021
FOR CHIEF BUILDING OFFICIAL DATE

STRUDET INC.

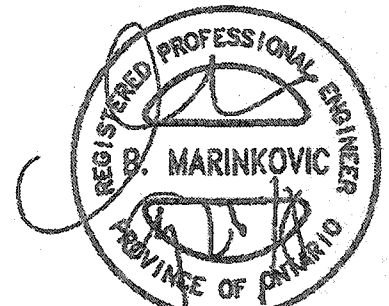

FOR STRUCTURE ONLY

2012 CODE
COMPLIANCE PACKAGE "A1"

6.			The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.	REGION DESIGN INC. 8700 DUFFERIN ST. CONCORD, ONTARIO	SHEET TITLE POURED CONCRETE STAIRS	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.
4.			QUALIFICATION INFORMATION		SCALE 3/8"=1'-0"	DATE JULY 2018
3.			Required unless design is exempt under Division C, Subsection 3.2.5 of the building code			
2.						
1.	ISSUED FOR PERMIT	JUL 30, 2018	VIKAS GAJJAR NAME	28770 SIGNATURE		
REVISIONS			PROJECT NAME RUSSELL GARDENS III			

Greenpark.