

CONSTRUCTION NOTES (UNLESS OTHERWISE NOTED)
ALL CONSTRUCTION TO ADHERE TO THESE PLANS AND SPECIFICATIONS AND TO CONFORM TO THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE CODES AND AUTHORITIES HAVING JURISDICTION. THESE REQUIREMENTS ARE TO BE TAKEN AS MINIMUM SPECIFICATIONS. ONT. REG. 952/12 - 2012 OBC.

- 1 ROOF CONSTRUCTION (*SEE OBC 9.19.)
NO. 210 (10.25kg/m²) ASPHALT SHINGLES, 10mm (3/8") PLYWOOD SHEATHING WITH "H" CLIPS. APPROVED WOOD TRUSSES @600mm (24") o.c. MAX. APPROVED EAVE PROTECTION TO EXTEND 900mm (3'-0") FROM EDGE OF ROOF AND MIN. 300mm (12") BEYOND INNER FACE OF EXTERIOR WALL. 28x24 (2"x4") TRUSS BRACINGS @ 1630mm (6'-0") o.c. AT BOTTOM CHORD. PREFIN. ALUM. EAVESTROUGH, FASCIA, RAIL & VENTED SOFFIT. PROVIDE ICE & WATER SHIELD TO ALL ROOF / WALL SURFACES SUSCEPTIBLE TO DAMPING. ROOF SHEATHING TO BE FASTENED 150 (6") o.c. ALONG EDGES & INTERMEDIATE SUPPORTS WHEN TRUSSES SPACED GREATER THAN 406 (16"). ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH 50% AT EAVES.


- 2 FRAME WALL CONSTRUCTION (2"x6")
SIDING, HARDIE BOARD, STUCCO BOARD OR EQUAL AS PER ELEVATION. 1X6x4 (1"x3") VERTICAL WOOD FURRING. APPROVED SHEATHING PAPER, 1/16" O.S.B. EXTERIOR SHEATHING OR OBC COMPLIANT EQUIVALENT. 38x140 (2"x6") STUDS @ 400mm (16") o.c. UNAPPROVED DIAGONAL WALL BRACINGS. RSI 3.81 (R22) INSULATION AND APPROVED VAPOUR BARRIER AND APPROVED CONT. AIR BARRIER. 15mm (1/2") INT. DRYWALL FINISH.

- 3 BRICK VENEER CONSTRUCTION (2"x6")
90mm (4") FACE BRICK 25mm (1") AIR SPACE. 22x120x40.76mm (1/8"x4"x0.09") GALV. METAL TIES @ 400mm (16") o.c. HORIZONTAL 600mm (24") o.c. VERTICAL. APPROVED SHEATHING PAPER, 1/16" O.S.B. EXTERIOR SHEATHING OR OBC COMPLIANT EQUIVALENT. 38x140 (2"x6") STUDS @ 400mm (16") o.c. UNAPPROVED DIAGONAL WALL BRACINGS. RSI 3.81 (R22) INSUL. APPROVED VAPOUR BARRIER AND APPROVED CONT. AIR BARRIER. 15mm (1/2") INT. DRYWALL FINISH. PROVIDE KEEPS HOLES @ 800mm (32") o.c. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER.

- 3A STUCCO WALL CONSTRUCTION (2"x6")
STUCCO CLADDING SYSTEM CONFIRMING TO OBC 9.21.1.1.1 & 9.26 THAT EMPLOY A MINIMUM 6mm (1/4") DRAINAGE CAVITY BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED AS PER MANUFACTURERS SPECIFICATION ON 25mm (1") MINIMUM EXTRUDED OR EXPANDED RIGID INSULATION. APPROVED SHEATHING PAPER, 1/16" O.S.B. EXTERIOR SHEATHING OR OBC COMPLIANT EQUIVALENT. 38x140 (2"x6") STUDS @ 400mm (16") o.c. UNAPPROVED DIAGONAL WALL BRACINGS. RSI 3.81 (R22) INSUL. APPROVED VAPOUR BARRIER AND APPROVED CONT. AIR BARRIER. 15mm (1/2") INT. DRYWALL FINISH. STUCCO TO BE MIN. 200mm (8") ABOVE FINISH GRADE.

- 4 INTERIOR STUD PARTITIONS (*SEE OBC 9.23.10.8.9.23.11.1)
BEARING PARTITION 38x24 (2"x4") @ 400mm (16") o.c. FOR 2 STOREYS AND 300mm (12") o.c. FOR 3 STOREYS. NON-BEARING PARTITIONS 38x24 (2"x4") @ 600mm (24") o.c. PROVIDE 38x24 (2"x4") BOTTOM PLATE AND 2/38x24 (2"x4") TOP PLATE. 15mm (1/2") INTERIOR DRYWALL. BOTH SIDES OF STUD, PROVIDE 38x140 (2"x6") STUDS/PLATES WHERE NOTED.

- 5 FOUNDATION WALL/FOOTINGS: (*SEE OBC 9.15.3 & 9.15.4.)
MIN. 200mm (8") POURED CONC. FDN. WALL 15MPa (2200psi) WITH BITUMINOUS DAMPROOFING AND DRAINAGE LAYER. MIN. 400x100 (16"x4") CONTIN. KEYED CONC. PTB. BRACE FOUNDATION WALL PRIOR TO BACKFILLING. ALL FOOTINGS SHALL REST ON NATURAL UNDISTURBED SOIL WITH MINIMUM BEARING CAPACITY OF 120kPa (11.4 psi) OR GREATER.

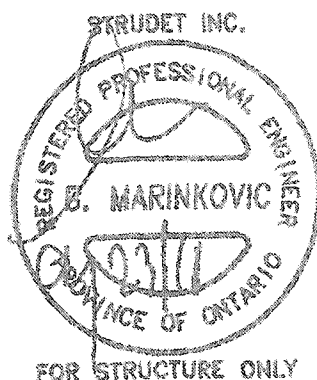

NO.	REVISIONS	DATE
1.	ISSUED FOR PERMIT	JUL 30, 2018
2.		
3.		
4.		
5.		

- 6 WEeping TILE (*SEE OBC 9.14.3.)
100mm (4") DIA. WEeping TILE 150mm (6") CRUSHED STONE OVER AND AROUND WEeping TILES.
- 7 BASEMENT SLAB (*SEE OBC 9.16.)
80mm (3") MIN. 25MPa (3600psi) CONC. SLAB ON 100mm (4") COARSE GRANULAR FILL OR 15MPa (2200psi) CONC. WITH DAMPROOFING BELOW SLAB.
- 8 WOOD SUBFLOORS (*SEE OBC 9.23.14. & 9.30.2.1)
19mm (3/4") T&G SUBFLOOR UNDER GROUND FLOOR FINISH FLOOR. 19mm (3/4") T&G SUBFLOOR UNDER SECOND FLOOR FINISH FLOOR. 19mm (3/4") PANEL-TYPE UNDERLAY FOR CERAMIC TILE APPLICATION. 6mm (1/4") PANEL-TYPE UNDERLAY UNDER RESILIENT & PARQUET FLOORING.
- 9 ROOF INSULATION (*SEE 9.21.2.1.1.2.A & 2.1.1.7)
RSI 10.57 (R60) ROOF INSULATION AND APPROVED VAPOUR BARRIER. 15mm (5/8") INT. DRYWALL FINISH OR APPROVED EQUAL.
- 10 ALL STAIRS/EXTERIOR STAIRS (*SEE OBC 9.8.)
MAX. RISE = 200 (1'-10")
MIN. RUN = 210 (6'-10")
MIN. TREAD = 250 (8'-10")
MAX. NOSING = 25 (1")
MIN. HEADROOM = 1900 (6'-3")
RAIL @ LANDING = 400 (1'-4")
RAIL @ STAIR = 900 (2'-10") TO 465 (1'-9")
MIN. STAIR WIDTH = 860 (2'-10")

FOR CURVED STAIRS
MIN. AVE. RUN = 200 (6")
MIN. RUN = 150 (5")
- 11 RAILING (*SEE OBC 9.8.8.1)
FINISHED RAILING ON PICKETS SPACED MAXIMUM 100mm (4") BETWEEN PICKETS.

INTERIOR GUARDS = 900mm (2'-10") MIN.
EXTERIOR GUARDS = 1010mm (3'-4") MIN.
- 12 SILL PLATE (*SEE OBC 9.23.6 & 9.23.7)
38x24 (2"x4") SILL PLATE WITH 15mm (1/2") DIA. ANCHOR BOLTS 200mm (8") LONG, EMBEDDED MIN. 100mm (4") INTO CONC. @ 2400mm (1'-10") o.c. GASKING OR 25 (1") MIN. MINERAL WOOL BETWEEN PLATE AND TOP OF FDN. WALL. USE MORTAR TO LEVEL SILL PLATE WHEN REQUIRED.
- 13 BASEMENT INSULATION (*SEE OBC 12.3.)
FOUNDATION WALLS ENCLOSING HEATED SPACE SHALL BE INSULATED FROM THE UNDERSIDE OF THE SUBFLOOR TO NOT MORE THAN 152mm (6") ABOVE THE FINISHED FLOOR OF THE BASEMENT AND NOT LESS THAN 60mm (2") TO THE SLAB.
FOUNDATION WALL INSULATION SHALL BE MINIMUM RSI 3.52 (R20) BLANKET INSULATION. APPROVED VAPOUR BARRIER. DAMPROOFING WELDS. PAPER BETWEEN THE FDN. AND INSUL.
- 14 BASEMENT BEARING STUD PARTITION (*SEE OBC 9.23.10.1)
38x24 (2"x4") STUDS @ 400mm (16") o.c. 38x24 (2"x4") SILL PLATE ON DAMPROOFING MATERIAL. 15mm (1/2") DIA. ANCHOR BOLTS 200mm (8") LONG, EMBEDDED MIN. 100mm (4") INTO CONC. @ 2400mm (1'-10") o.c. (4") HIGH CONC. CURB ON 38x24 (2"x4") CONC. FOOTING. ADD HORIZ. BLOCKING AT MID-HEIGHT IF WALL IS UNFINISHED.
- 15 STEEL BASEMENT COLUMN (*SEE OBC 9.17.3.1)
90mm (3-1/2") DIA. x 4.72mm (186) STL. COL. WITH 150x150x12mm (6"x6"x1/2") STL. TOP & BOTTOM PLATE.
- 15A STEEL COLUMN (*SEE OBC 9.17.3.1)
90mm (3-1/2") DIA. x 4.72mm (186) STL. COLUMN WITH 100x100x6.1mm (4"x4"x1/4") STEEL TOP & BOTTOM PLATE. FIELD FIELD BOTTOM PLATE TO 250x100x12mm (10"x4"x1/2") BASE PLATE C/A 2-13mm (1/2") DIA. x 500mm (12") LONG x 50mm (2") HOOK ANCHORS.
- 16 NIS WALLS (*SEE OBC 9.23.8.)
BEAM POCKET OR 300x200 (6"x8") POURED CONCRETE NIS WALLS. MINIMUM BEARING 90mm (3-1/2")
- 17 STEEL BEAM STRAPPING (*SEE OBC 9.23.4.3. (316))
4038 (1'-2") CONTINUOUS WOOD STRAPPING BOTH SIDES OF STEEL BEAM.
- 18 GARAGE SLAB (*SEE OBC 9.16.)
100mm (4") 32MPa (4640psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT ON OPT. 100 (4") COARSE GRANULAR FILL WITH COMPACTED SUB-BASE OR COMPACTED NATIVE FILL. SLOPE TO FRONT IS MIN.
- 19 INTERIOR GARAGE WALLS & CEILING (*SEE OBC 9.10.9.15.1)
15mm (1/2") GYPSUM BOARD ON WALL AND CEILING BETWEEN HOUSE AND GARAGE. RSI 3.81 (R22) IN WALLS. RSI 5.46 (R31) IN CEILING. TAPE AND SEAL ALL JOINTS GAS TIGHT.

- 20 GARAGE DOOR GASPROOFING (*SEE OBC 9.10.13.15.)
DOOR AND FRAME GASPROOFING. DOOR EQUIPPED WITH SELF CLOSING DEVICE AND WEATHER STRIPPING.
- 21 EXTERIOR STEP (*SEE OBC 9.8.9.2, 9.8.9.3 & 9.8.10.)
PRECAST CONCRETE STEP OR WD. STEP WHERE NOT EXPOSED TO WEATHER MAX. RISE 200mm (1'-10"). MINIMUM TREAD 230mm (9-1/2")
- 22 DRYER VENT (*SEE OBC 6.2.3.8. (7))
CAPPED DRYER EXHAUST VENTED TO EXTERIOR. USE 100mm (4") DIA. SMOOTH WALL VENT PIPE.
- 23 ATTIC ACCESS (*SEE OBC 9.19.2.1)
ATTIC ACCESS HATCH 545x100 (2'-2") WITH WEATHERSTRIPPING. RSI 5.46 (R31) RIGID INSULATION BACKING.
- 24 FIREPLACE CHIMNEYS (*OBC 9.21.)
TOP OF FIREPLACE CHIMNEY SHALL BE 915mm (3'-0") ABOVE THE HIGHEST POINT AT WHICH IT COMES IN CONTACT WITH THE ROOF AND 610mm (2'-0") ABOVE THE ROOF SURFACE WITHIN A HORIZ. DISTANCE OF 3030mm (10'-0") FROM THE CHIMNEY.
- 25 LINEN CLOSET
4 SHELVES MIN. 380mm (14") DEEP.
- 26 MECHANICAL EXHAUST (*SEE OBC 9.32.3.5, 9.32.3.10.)
MECHANICAL EXHAUST FAN VENTED TO EXTERIOR.
- 27 STEEL BEARING PLATE FOR MASONRY WALLS
280x250x16 (11"x11"x5/8") STL. PLATE FOR STL BEAMS AND 280x280x12 (11"x11"x1/2") STL. PLATE FOR WOOD BEAMS BEARING ON CONC. BLOCK PARTYWALL. ANCHORED W/ 2-19mm (3/4") x200mm (8") LONG GALV. ANCHORS WITHIN SOLID BLOCK COURSE. LEVEL WITH NON-SHRINK GROUT.
- 28 GLASS "B" VENT (*SEE OBC 9.17.4.)
ULC. RATED GLASS "B" VENT 610mm (2'-0") ABOVE THE POINT IN CONTACT WITH THE ROOF FOR SLOPES UP TO 1/12, REFER TO THE ONTARIO GAS UTILIZATION CODE.
- 29 WOOD BASEMENT POST (*OBC 9.17.4.)
3-38x140 (3-2"x6") BUILT-UP POST ON METAL BASE SHOE ANCHORED TO CONC. WITH 12.7 (1/2") DIA. BOLT ON 406x106x12.5 (16"x16"x1/2") CONC. FOOTING.
- 30 STEP FOOTINGS (*OBC 9.15.3.9.1)
MIN. HORIZ. STEP = 610mm (24"). MAX. VERT. STEP = 610mm (24")
- 31 SLAB ON GRADE (*SEE OBC 9.16.)
100mm (4") 32MPa (4640psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT ON OPT. 100 (4") COARSE GRANULAR FILL WITH COMPACTED SUB-BASE OR COMPACTED NATIVE FILL. REINFORCED W/ 6x6-x12.5x12.5 MESH PLACED NEAR MID-DEPTH OF SLAB.
- 32 DIRECT VENT FURNACE (*SEE OBC 23.9.4.1)
DIRECT VENT FURNACE TERMINAL MIN. 900mm (36") FROM A GAS REGULATOR. MIN 300mm (12") ABOVE FIN. GRADE. FROM ALL OPENINGS, EXHAUST & INTAKE VENTS. HRV INTAKE TO BE A MIN. OF 1830mm (6'-0") FROM ALL EXHAUST TERMINALS. REFER TO GAS UTILIZATION CODE. ALL AIR INTAKES SHALL BE LOCATED SO THAT THEY ARE SEPARATED FROM KITCHEN EXHAUST BY 3.0m IN COMPLIANCE WITH O.B.C. DIV. B TABLE 6.2.3.12.
- 33 DIRECT VENT GAS FIREPLACE
DIRECT VENT GAS FIREPLACE. VENT TO BE A MINIMUM 300mm (12") FROM ANY OPENING AND ABOVE FIN. GRADE. REFER TO GAS UTILIZATION CODE
- 34 JOIST STRAPPING & BRIDGING (*SEE OBC 23.9.4.1)
ALL FLOOR JOISTS TO BE BRIDGED WITH 38x38 (2"x2") CROSS BRACING OR SOLID BLOCKING @2100mm (8'-10") o.c. MAX. 13x64 (1"x8") @2100mm (8'-10") o.c. UNLESS A PANEL TYPE CEILING FINISH IS APPLIED.
- 35 EXPOSED BUILDING FACE (*SEE OBC 9.10.15.1)
EXTERIOR WALLS TO HAVE A FIRE RESISTANCE RATING OF NOT LESS THAN 45min. WHERE LIMITING DISTANCE IS LESS THAN 1.2M (3'-11") WHERE THE LIMITING DISTANCE IS LESS THAN 600mm (1'-11") THE EXPOSING FACE SHALL BE GLAD IN NON-COMBUSTIBLE MATERIAL.
- 36 COLD CELLAR PORCH SLAB (*SEE OBC 9.40.1)
FOR MAX. 2500mm (8'-2") PORCH DEPTH, 125mm (5") 32MPa (4640 psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT. REINF. WITH 10M BARS @200mm (8") o.c. EACH WAY IN BOTTOM THIRD OF SLAB. ANCHORED IN PERIMETER FDN. WALLS W/ 610x10 (24"x24") 10M @600mm (24") o.c. DOWELS. SLOPE SLAB MIN. 1.0% FROM DOOR. SLAB TO HAVE A MIN. 75mm (3") BEARING ON FDN. WALLS. PROVIDE (KL) LINTELS OVER CELLAR DOOR.

- 37 FDN. WALL REDUCTION IN THICKNESS (*SEE OBC 9.15.4.7.)
FDN. WALL SHALL NOT BE REDUCED TO LESS THAN 90mm (3-1/2") THICK TO A MAX. DEPTH OF 660mm (26") FOR 6" FDN. WALL. 10" FDN. WALL WHEN REDUCTION IN THICKNESS IS GREATER THAN 26". FDN. WALL SHALL BE TIED TO THE FACING MATERIAL WITH METAL TIES SPACED 200mm (8") o.c. VERTICALLY AND 100mm (4") o.c. HORIZONTALLY. FILL SPACE BETWEEN WALL AND FACING SOLID WITH MORTAR.
- 38 CONVENTIONAL ROOF FRAMING (*SEE OBC 9.23.4.2.111)
FOR MAX. 2240mm (7'-4") SPAN, 38x24 (2"x4") RAFTERS @400mm (16") o.c. FOR MAX. 3330mm (11'-1") SPAN, 38x140 (2"x6") RAFTERS @400mm (16") o.c. RIDGE BOARD TO BE 51mm (2") DEEPER. 38x24 (2"x4") COLLAR TIES AT MIDSPAN. CEILING JOISTS TO BE 38x24 (2"x4") @400mm (16") o.c. FOR MAX. 2830mm (9'-3") SPAN & 38x140 (2"x6") @ 400 (16") o.c. FOR MAX. 4450mm (14'-7") SPAN. RAFTERS FOR BUILT-UP ROOF TO BE 38x24 (2"x4") @600mm (24") o.c. WITH A 38x24 (2"x4") CENTER POST TO THE TRUSS BELOW. LATERALLY BRACED @1800mm (6'-0") o.c. VERTICALLY.
- 39 TWO STOREY VOLUME SPACES
FOR A MAXIMUM 5400mm (18'-0") HEIGHT, PROVIDE 2-38x140 (2-2"x6") CONTINUOUS STUDS @300mm (12") o.c. FOR BRICK AND 400mm (16") o.c. FOR SIDING. PROVIDE SOLID WOOD BLOCKING BETWEEN STUDS @1220mm (4'-0") o.c. VERT. 1/16" EXT. PLYWOOD.
- 40 EXPOSED FLOOR TO EXTERIOR (*9.21.2.1.1.2.A)
PROVIDE RSI 5.46 (R31) INSULATION. APPROVED VAPOUR BARRIER AND CONTINUOUS AIR BARRIER. FINISHED SOFFIT.
- 41 PARTYWALLS
TYPICAL 1 HOUR RATED PARTYWALL. REFER TO DETAILS FOR TYPE AND SPECIFICATIONS.
- 42 EXTERIOR WALLS FOR WALK-OUT CONDITION
THE EXTERIOR BASEMENT STUD WALL TO BE 38x140mm (2"x6") STUDS @400mm (16") o.c. MATCH FLOOR JOIST SPACING WHEN PARALLEL WITH FLOOR JOISTS.
- 43 SMOKE ALARM (*OBC 9.10.19)
PROVIDE 1 PER FLOOR, NEAR THE STAIRS CONNECTING THE FLOOR LEVEL AND ALSO 1 IN EACH BEDROOM NEAR HALL DOOR. ALARMS TO BE CONNECTED TO AN ELECTRICAL CIRCUIT AND INTERCONNECTED TO ACTIVATE ALL ALARMS IF ONE SOUNDS. BATTERY BACK-UP REQUIRED. SMOKE ALARMS TO INCORPORATE VISUAL SIGNALLING COMPONENT. (9.10.19.3.13).
- 44 CARBON MONOXIDE ALARM (*OBC 9.33.4.)
WHERE A FUEL-BURNING APPLIANCE IS INSTALLED IN A DWELLING UNIT, A CARBON MONOXIDE DETECTOR CONFORMING TO CAN/CGA-6.19, CSA 6.19 OR UL2034 SHALL BE INSTALLED ADJACENT TO EACH SLEEPING AREA. CARBON MONOXIDE DETECTOR(S) SHALL BE PERMANENTLY WIRED SO THAT IT IS ACTIVATION WILL ACTIVATE ALL CARBON MONOXIDE DETECTORS AND BE EQUIPPED WITH AN ALARM THAT IS AUDIBLE WITHIN BEDROOMS WHEN THE INTERVENING DOORS ARE CLOSED
- 45 SOIL GAS CONTROL (*OBC 9.13.4.)
PROVIDE CONSTRUCTION TO PREVENT LEAKAGE OF SOIL GAS INTO THE BUILDING AS REQUIRED.

CITY OF HAMILTON
Building Division

Permit No. 21-107137

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAWS
These drawings and/or specifications have been reviewed by
FOR CHIEF BUILDING OFFICIAL
DATE

2012 CODE
COMPLIANCE PACKAGE "A1"

Greenpark.

PROJECT NAME
RUSSELL GARDENS III

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.
QUALIFICATION INFORMATION
Required unless design is exempt under Division C, Subsection 2.2.5 of the building code
VIKAS GAJJAR
NAME
28770
BCIN

REGION DESIGN INC.
8700 RUFFERN ST.
CONCORD, ONTARIO
L4K 1S6
P (416) 736-4006
F (905) 606-0746

GENERAL NOTES
SCALE
N.T.S.
DATE
JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.
PAGE No.
1

WINDOWS - CANADA ZONE B

- (1) MINIMUM BEDROOM WINDOW (OBC 9.9.10.1.)
AT LEAST ONE BEDROOM WINDOW ON A GIVEN FLOOR IS TO HAVE MIN. 0.35m² (3.8 SQFT) UNOBSTRUCTED GLAZED OPENABLE AREA WITH MIN. CLEAR WIDTH OF 350mm (1'-3") GLASS AREA NOT MORE THAN 75% OF GROSS PERIPHERAL WALL AREA.
MAXIMUM U-VALUE 0.22
- (2) WINDOW GUARDS (OBC 9.8.8.1(6))
A GUARD IS REQUIRED WHERE THE TOP OF THE WINDOW SILL IS LOCATED LESS THAN 400mm (1'-6") ABOVE FIN. FLOOR AND THE DISTANCE FROM THE FIN. FLOOR TO THE ADJACENT GRADE IS GREATER THAN 1800mm (5'-11")

GENERAL:

- (1) MECHANICAL VENTILATION
MECHANICAL VENTILATION IS REQUIRED TO PROVIDE 0.3 AIR CHANGES PER HOUR AVERAGED OVER 24 HOURS. SEE MECHANICAL DRAWINGS.
- (2) OUTDOOR AIR INTAKE ●
ALL OUTDOOR AIR INTAKES SHALL BE LOCATED SO THAT THEY ARE SEPARATED FROM SOURCES OF CONTAMINATION (EXHAUST VENTS) IN COMPLIANCE WITH O.B.C. DIV.-B 6.2.3.12. AND TABLE 6.2.3.12.

- (3) REINFORCEMENT FOR GRAB BARS (OBC 9.5.2.3.1) ●
REINFORCEMENT OF STUD WALLS SHALL BE INSTALLED ADJACENT TO WATER CLOSETS AND SHOWER OR BATHUB IN MAIN BATHROOM. REFER TO O.B.C. 9.5.2.3, 9.5.2.3(a), 9.5.2.3(b), 9.5.2.3(c), 9.5.2.3(d), 9.5.2.3(e), 9.5.2.3(f), 9.5.2.3(g) & 9.5.2.3(h). SEE DETAIL ON PAGE II.

LUMBER:

- 1) ALL LUMBER SHALL BE SPRUCE-PINE-FIR No.1&2 GRADE, UNLESS NOTED OTHERWISE.
- 2) LUMBER EXPOSED TO THE EXTERIOR TO BE SPRUCE-PINE-FIR No.1&2 GRADE PRESSURE TREATED OR CEDAR, UNLESS NOTED OTHERWISE.
- 3) ALL BEAMS, GIRDER TRUSSES, AND METAL HANGER CONNECTIONS SUPPORTING ROOF FRAMING TO BE DESIGNED & CERTIFIED BY TRUSS MANUFACTURER.
- 4) LVL BEAMS SHALL BE 2.0E (F_b=2800psi MIN.), NAIL EACH PLY OF LVL WITH 89mm (3-1/2") LONG COMMON WIRE NAILS @ 300mm (12") O.C. STAGGERED IN 2 ROWS FOR 104, 240, & 300mm (7-1/4", 9-1/2", 11-1/8") DEPTHS AND STAGGERED IN 3 ROWS FOR GREATER DEPTHS AND FOR 4 PLY MEMBERS ADD 1/2" (13mm) DIA. GALVANIZED BOLTS BOLTED AT MID-DEPTH OF BEAM @ 915mm (3'-0") O.C.
- 5) PROVIDE TOP MOUNT BEAM HANGERS FOR ALL LVL BEAM TO BEAM CONNECTIONS UNLESS NOTED OTHERWISE.
- 6) PROVIDE METAL JOIST HANGERS FOR ALL JOISTS AND BUILT-UP WOOD MEMBERS INTERSECTING FLUSH BUILT-UP WOOD MEMBERS.
- 7) WOOD FRAMING NOT TREATED WITH A WOOD PRESERVATIVE, IN CONTACT WITH CONCRETE, SHALL BE SEPARATED FROM THE CONC. BY AT LEAST 2mil. POLYETHYLENE FILM No.50 (45lbs) ROLL ROOFING OR OTHER DAMPROOFING MATERIAL, EXCEPT WHERE THE WOOD MEMBER IS AT LEAST 150mm (6") ABOVE THE GROUND.

STEEL:

STRUCTURAL STEEL AND HOLLOW STRUCTURAL SECTIONS SHALL CONFORM TO CAN/CSA-S40-21 GRADE 350W.
REINFORCING STEEL SHALL CONFORM TO CSA-G30-10M GRADE 400R.

REVISION:

● CNT. REG. 332/12-2012 OBC AMENDMENT O. REG. 03/19 JAN. 01, 2020

STABILITY OF NARROW (20'-25') & TALL (±30') HOUSES

BUILDER TO PROVIDE SUFFICIENT TEMPORARY BRACINGS TO RESIST WIND LOADING WHEN UNDER CONSTRUCTION. FURTHER RECOMMENDATIONS:

- 1) REDUCE THE FOUNDATION WALL SILL PLATE ANCHOR BOLT SPACING FROM 2400mm o.c. (7'-10") TO 1220mm o.c. (4'-0") FOR STANDARD CONDITIONS.
- 2) USE 45mm (3/8") THICK PLYWOOD OR WAFERBOARD FOR THE EXTERIOR WALL SHEATHING.
- 3) TO STIFFEN THE STRUCTURE IN TRANSVERSE DIRECTION USE 45mm (3/8") THICK PLYWOOD NAILED TO THE INTERIOR PARTITIONS ON EACH FLOOR FOR A MINIMUM 2 INTERIOR PARTITION WALLS ON BOTH SIDES AND PERPENDICULAR TO THE LONG WALLS.

BRICK VENEER LINTELS

WL1 = 3'-1/2"x8'-1/2"x16" (90x90x40) + 2-2"x8" SFR. No.2
WL2 = 4'-0"x12'-3/4"x16" (100x90x40) + 2-2"x8" SFR. No.2
WL3 = 5'-0"x12'-3/4"x16" (125x90x40) + 2-2"x10" SFR. No.2
WL4 = 6'-0"x12'-3/4"x16" (150x90x40) + 2-2"x12" SFR. No.2
WL5 = 6'-6"x12'-3/4"x16" (150x90x40) + 2-2"x12" SFR. No.2
WL6 = 5'-0"x12'-3/4"x16" (125x90x40) + 2-2"x10" SFR. No.2
WL7 = 5'-0"x12'-3/4"x16" (125x90x40) + 2-2"x10" SFR. No.2
WL8 = 5'-0"x12'-3/4"x16" (125x90x40) + 2-2"x10" SFR. No.2
WL9 = 6'-0"x12'-3/4"x16" (150x90x40) + 2-2"x12" SFR. No.2

WOOD LINTELS AND BEAMS

WB1 = 2'-2"x8" SFR. No.2 (2-35x104 SFR. No.2)
WB2 = 3'-2"x8" SFR. No.2 (3-35x104 SFR. No.2)
WB3 = 2'-2"x10" SFR. No.2 (2-35x125 SFR. No.2)
WB4 = 3'-2"x10" SFR. No.2 (3-35x125 SFR. No.2)
WB5 = 2'-2"x12" SFR. No.2 (2-35x125 SFR. No.2)
WB6 = 3'-2"x12" SFR. No.2 (3-35x125 SFR. No.2)
WB7 = 5'-2"x12" SFR. No.2 (5-35x125 SFR. No.2)
WB8 = 4'-2"x10" SFR. No.2 (4-35x125 SFR. No.2)
WB9 = 4'-2"x12" SFR. No.2 (4-35x125 SFR. No.2)

LOOSE STEEL LINTELS

L1 = 3'-1/2"x8'-1/2"x16" (90x90x40)
L2 = 4'-0"x12'-3/4"x16" (100x90x40)
L3 = 5'-0"x12'-3/4"x16" (125x90x40)
L4 = 6'-0"x12'-3/4"x16" (150x90x40)
L5 = 6'-6"x12'-3/4"x16" (150x90x40)
L6 = 7'-0"x12'-3/4"x16" (175x90x40)

LAMINATED VENEER LUMBER (LVL) BEAMS

LVL1A = 4'-1 3/4" x 7 1/4" (4-45x104)
LVL1 = 2'-1 3/4" x 7 1/4" (2-45x104)
LVL2 = 3'-1 3/4" x 7 1/4" (3-45x104)
LVL3 = 4'-1 3/4" x 7 1/4" (4-45x104)
LVL4A = 4'-1 3/4" x 9 1/2" (4-45x140)
LVL4 = 2'-1 3/4" x 9 1/2" (2-45x140)
LVL5 = 3'-1 3/4" x 9 1/2" (3-45x140)
LVL6A = 4'-1 3/4" x 9 1/2" (4-45x140)
LVL6 = 2'-1 3/4" x 9 1/2" (2-45x140)
LVL7 = 3'-1 3/4" x 11 1/8" (3-45x300)
LVL8 = 4'-1 3/4" x 11 1/8" (4-45x300)
LVL9 = 2'-1 3/4" x 14" (2-45x350)
LVL10 = 3'-1 3/4" x 14" (3-45x350)
LVL11 = 2'-1 3/4" x 16" (2-45x400)

DOOR SCHEDULE

T = 2'-10" x 6'-8" (265x2033) - INSULATED ENTRANCE DOOR
1 = 2'-8" x 6'-8" (815x2033) - INSULATED FRONT DOORS
2 = 2'-8" x 6'-8" (815x2033) - WOOD & GLASS DOOR
3 = 2'-8" x 6'-8" x 1-3/4" (815x2033x45) - EXTERIOR SLAB DOOR
4 = 2'-8" x 6'-8" x 1-3/8" (815x2033x35) - INTERIOR SLAB DOOR
5 = 2'-6" x 6'-8" x 1-3/8" (760x2033x35) - INTERIOR SLAB DOOR
6 = 2'-2" x 6'-8" x 1-3/8" (660x2033x35) - INTERIOR SLAB DOOR
7 = 1'-6" x 6'-8" x 1-3/8" (460x2033x35) - INTERIOR SLAB DOOR

LEGEND

DJ	DOUBLE JOIST
TJ	TRIPLE JOIST
GT	GIRDER TRUSS
PL	POINT LOAD
SB	SOLID WOOD BEARING, SOLID BEARING TO BE WIDE AT LEAST AS SUPPORTED MEMBER. MIN. 3 PIECES.
LM	LOAD-BEARING WALL
TM	TWO-STORY WALL. SEE NOTE 39
FA	FLAT ARCH
FD	FLOOR DRAIN
SA	SMOKE ALARM. SEE NOTE 43
CA	SMOKE ALARM & CARBON MONOXIDE ALARM. SEE NOTE 44

CITY OF HAMILTON
Building Division


Permit No. 21-15739

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
FOR CHIEF BUILDING OFFICIAL DATE

2012 CODE
COMPLIANCE PACKAGE "A1"

Greenpark.

PROJECT NAME
RUSSELL GARDENS III

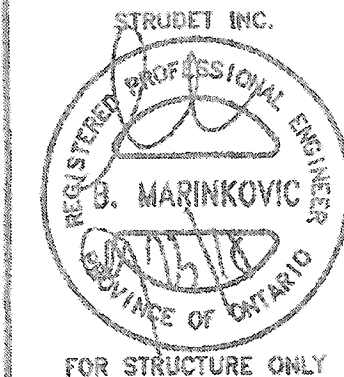

NO.	REVISIONS
5.	
4.	
3.	
2.	
1.	ISSUED FOR PERMIT JAN 31, 2015

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.
QUALIFICATION INFORMATION
Required unless design is exempt under Division C, Subsection 3.2.5 of the building code
Vikas Gajjar
NAME SIGNATURE
28770
BCIN

REGION DESIGN INC.
8700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S8
P (416) 736-4590
F (905) 660-0740

SHEET TITLE
GENERAL NOTES
SCALE
N.T.S.
DATE
JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.
PAGE No.
2



A FIREWALL SHALL EXTEND FROM THE GROUND CONTINUOUSLY THROUGH, OR ADJACENT TO, ALL STOREYS OF A BUILDING. (O.B.C. 3.1.10.5 (1))



THESE DRAWINGS AND/OR SPECIFICATIONS HAVE BEEN REVIEWED BY

[Signature] *MSR 1/2*

DATE


FOR THE BUILDING DEPARTMENT

FOR THE FIRE DEPARTMENT




ENGINEERED FLOOR SYSTEM INSTALLATION TO CONFORM
TO MANUFACTURER'S APPROVED DETAILS AND
SPECIFICATIONS



5.		The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 3.2.5 of the building code VIKAS GAJJAR  28770 NAME SIGNATURE RCIN	REGION DESIGN INC. 6700 DUFFERIN ST. CONCORD, ONTARIO L4K 4S6 P (416) 736-4046 F (905) 660-0746 REGION DESIGN INC.	SHEET TITLE FIRE WALL	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.	
4.						
3.						
2.						
1.	ISSUED FOR PERMIT JUL 30, 2016					
REVISIONS					PAGE No. 3	PROJECT NAME RUSSELL GARDENS III

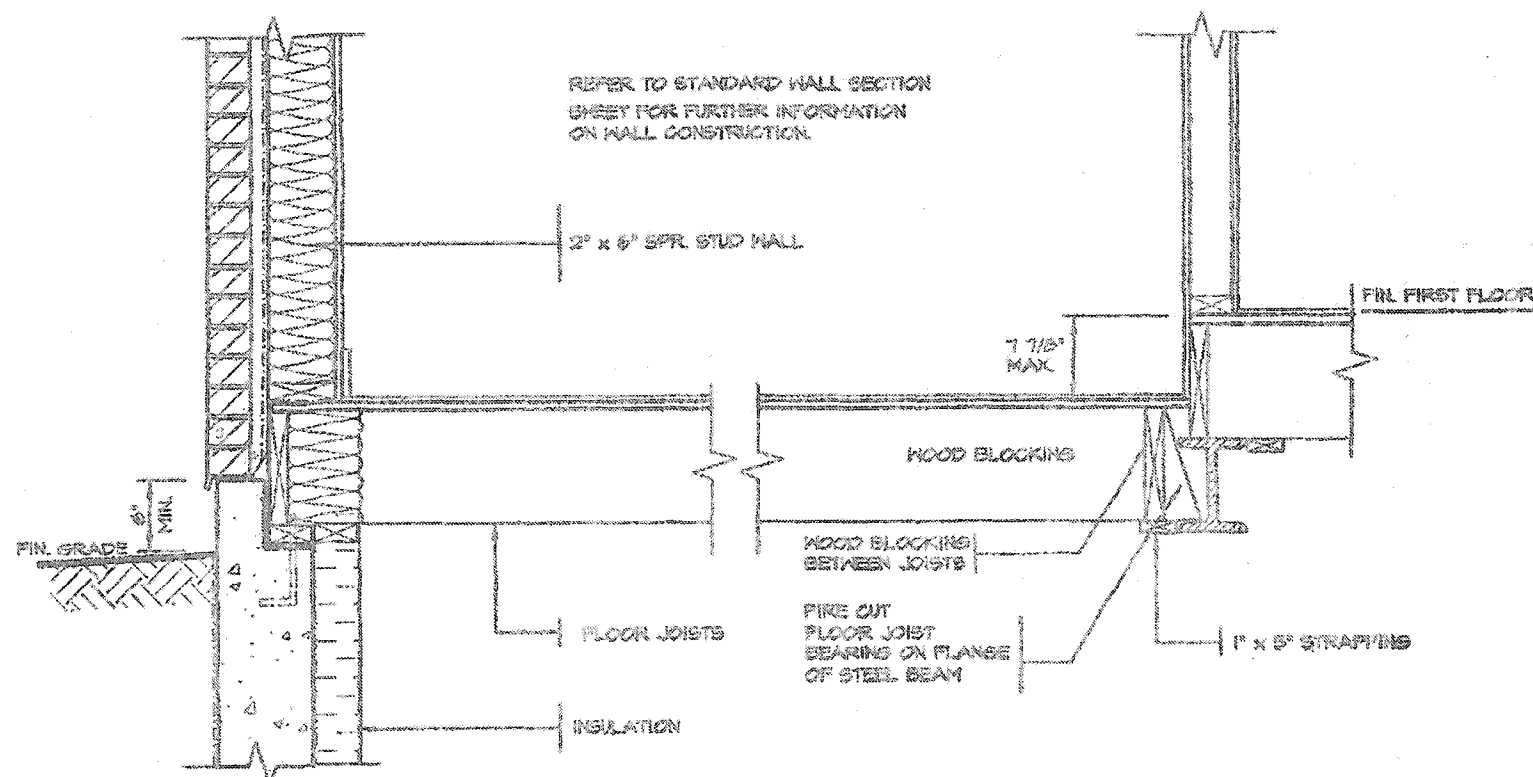

DETAIL OF SUNKEN LAUNDRY
(ONE RISER)

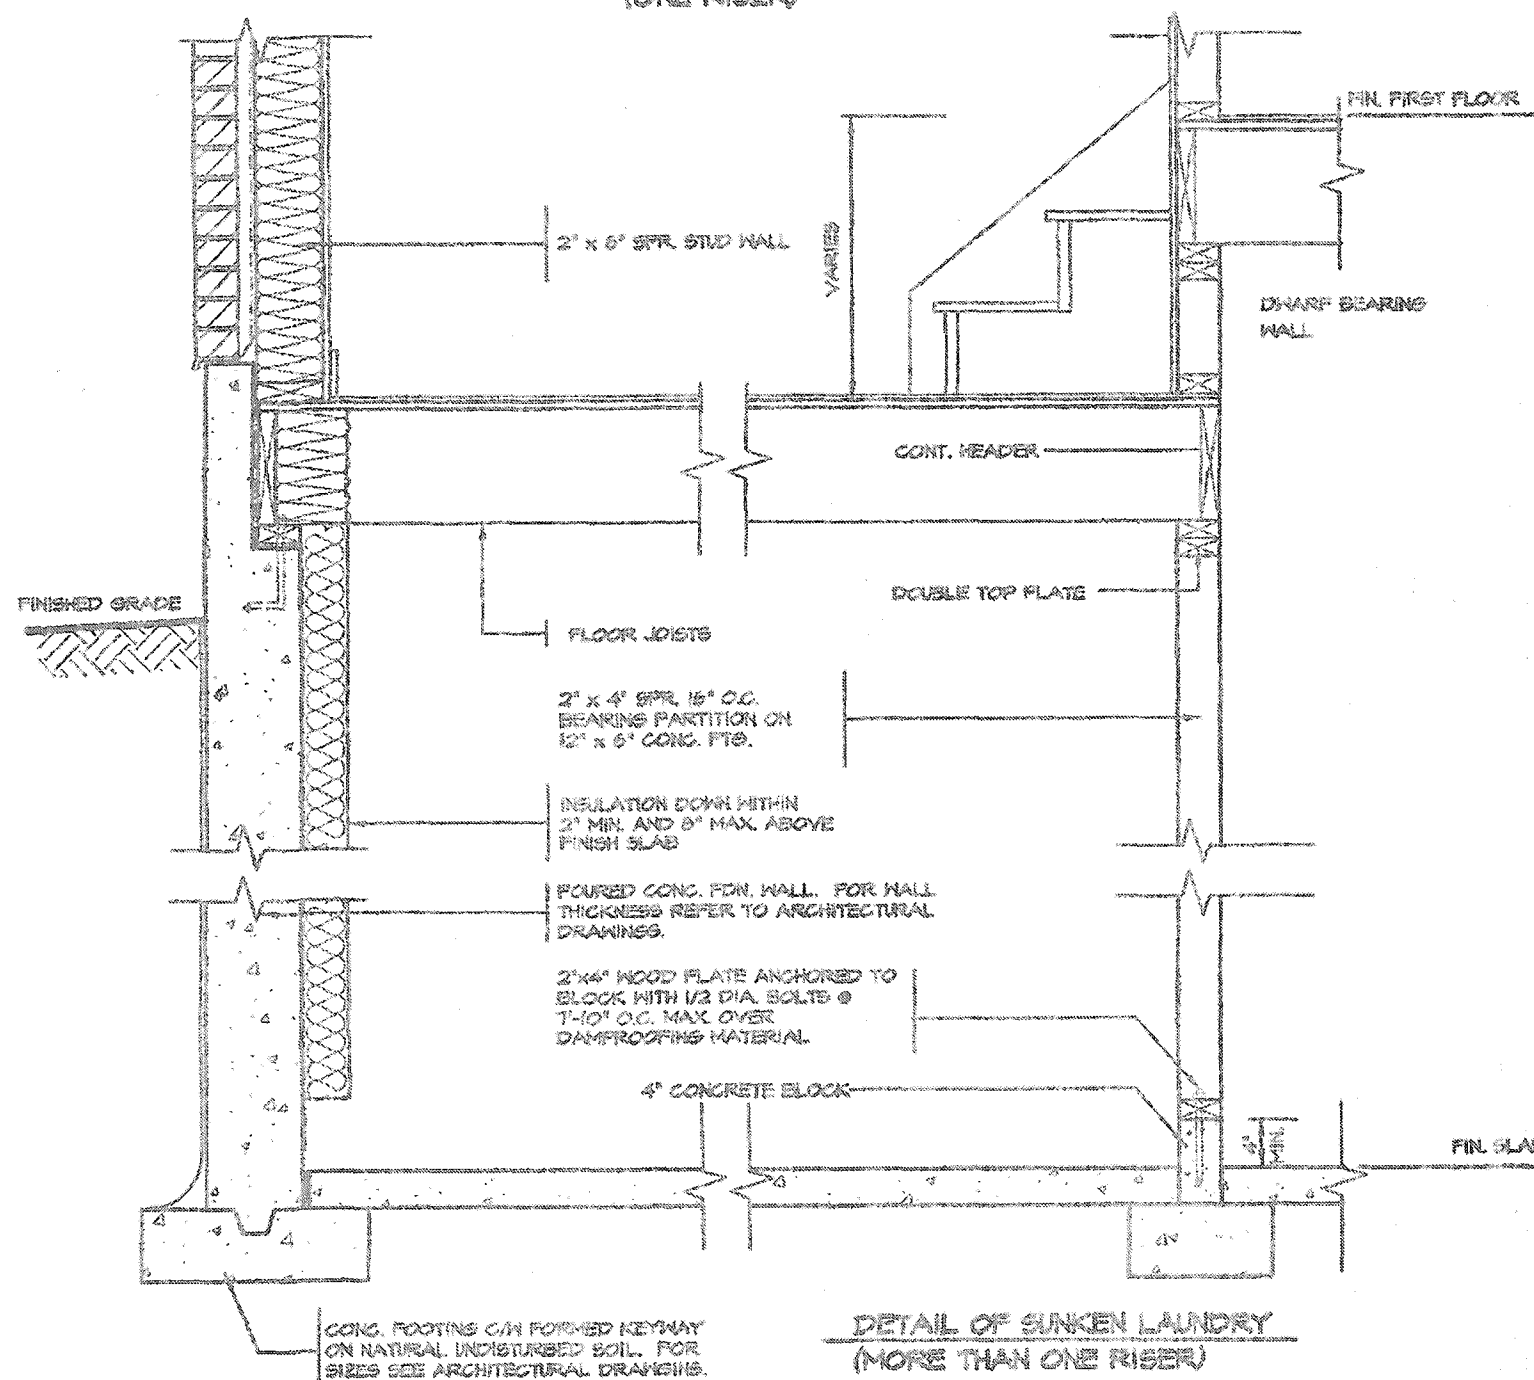

DETAIL OF SUNKEN LAUNDRY
(MORE THAN ONE RISER)

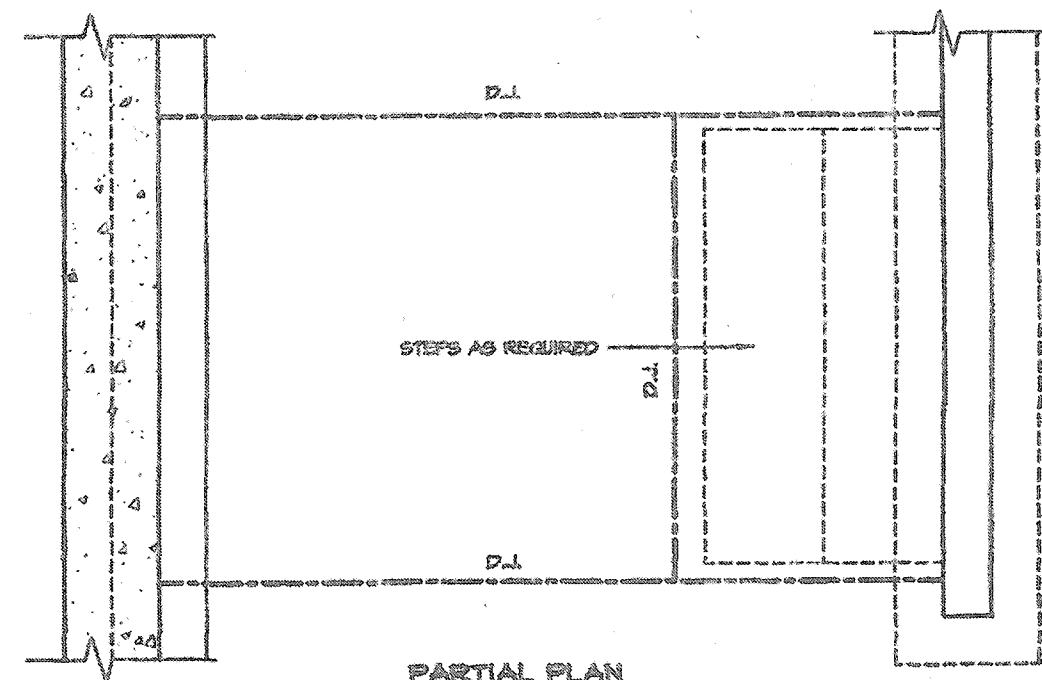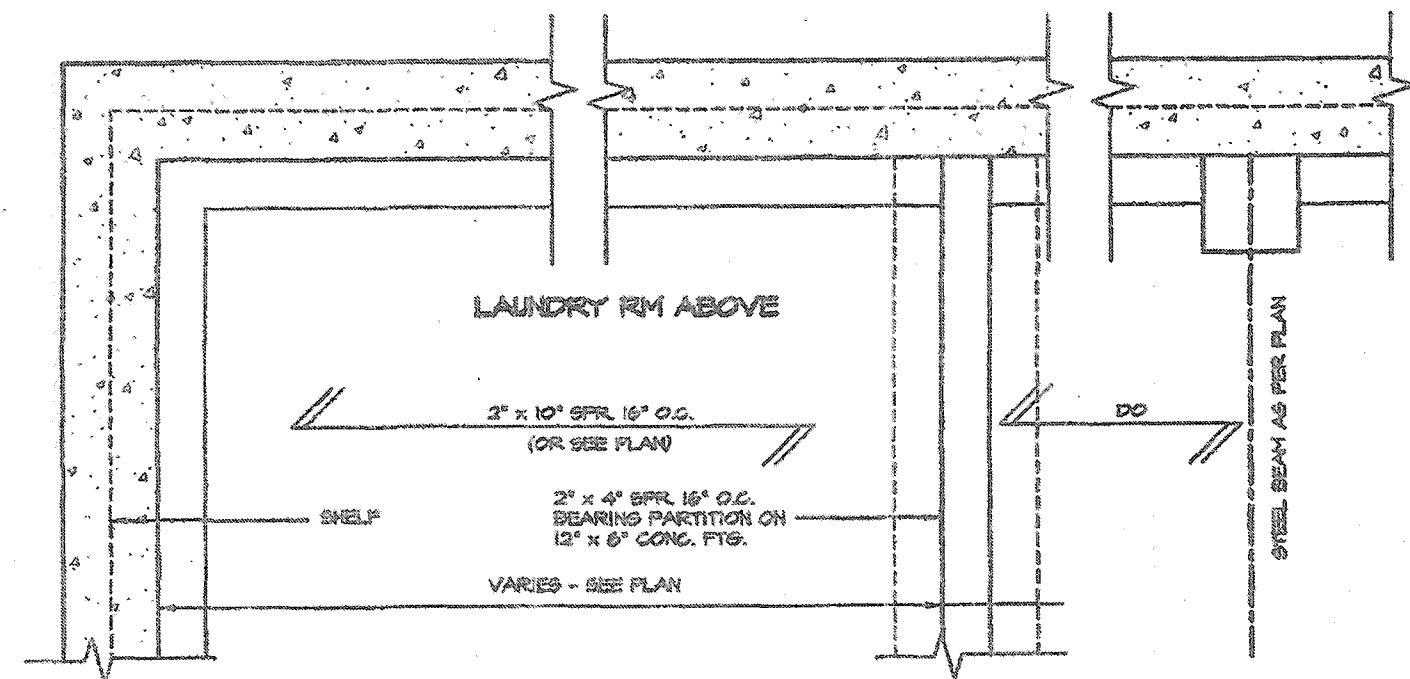

PARTIAL PLAN

CITY OF HAMILTON
Building Division

Permit No. **21-107139**
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAWS
These drawings and/or specifications have been reviewed by
[Signature] DATE **Mar 1/21**
FOR CHIEF BUILDING OFFICIAL



FOR STRUCTURE ONLY

2012 CODE
COMPLIANCE PACKAGE "A1"

REVISIONS	DATE
1. ISSUED FOR PERMIT	JUL 30, 2016

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.
QUALIFICATION INFORMATION
Required unless design is exempt under Division C, Subsection 3.2.5 of the building code
VIKAS GAJJAR
NAME
28770
SIGNATURE
BCIN

REGION DESIGN INC.
3700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S6
P (416) 730-6096
F (905) 660-0740

REGION
DESIGN
INC.

SHEET TITLE
**LAUNDRY DETAILS
SUNKEN**
SCALE
3/4"=1'-0"
DATE
JULY 2018

CONTRACTOR SHALL CHECK ALL
DIMENSIONS AND ELEVATIONS BEFORE
COMMENCING WITH WORK AND REPORT
ANY DISCREPANCIES TO THE DESIGNER.
PRINTS ARE NOT TO BE SCALED.
PAGE No.
5

Greenpark.
PROJECT NAME
RUSSELL GARDENS III



CITY OF HAMILTON
Building Division
Permit No. 21-157139
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
FOR CHIEF BUILDING OFFICIAL DATE 1/31

EAVE PROTECTION SHALL BE PROVIDED FROM THE EDGE OF ROOF
A MIN. 3'-0" (900mm) UP FROM THE ROOF SLOPE TO A LINE NOT LESS
THAN 1'-0" (300mm) INSIDE THE INNER FACE OF THE EXTERIOR WALL.
EAVE PROTECTION SHALL BE Laid BENEATH THE STARTER STRIP
AND SHALL CONSIST OF TYPE 'N' OR TYPE 'S' ASPHALT COATED
ROOFING SHEETS.
210 ASPHALT SHINGLES ON 5/8" PLYWOOD
SHEATHING USE 'W' CLIPS FOR TRUSSES
DAFFLES AS REQUIRED
FOR ROOF VENTILATION
PROVIDE ROOF VENTILATION @ A
RATE OF 1500 CFM OF INSULATED
CEILING AREA UNIFORMLY
DISTRIBUTED
ROOF TRUSSES @ 24" O.C. MAX.
RAISED HEEL TO MATCH PLATE

STARTER STRIP OF ROOF
SHINGLES REQUIRED

2"x6" FASCIA BOARD
PREFINISHED METAL
GUTTER FASCIA AND
VENTED SOFFIT

4" FACE BRICK TIED TO STUDS WITH
SALVANIZED 1/8" WIDE METAL TIES @
16" O.C. HORIZONTAL AND 24" O.C.
VERTICAL

1" AIR SPACE

1/2" BUILDING PAPER OVER 1/4" O.S.B.
EXTERIOR SHEATHING, 2"x6" GFR
STUDS @ 16" O.C. FILLED WITH R-22
INSULATION AND 6 MIL. POLY VAPOUR
BARRIER

CONTINUOUS HEADER JOIST W/ R-22
INSULATION W/ 6 MIL. VAPOUR BARRIER
AND SEAL TO JOIST AND SUBFLOOR

SCREENED KEEPING HOLES 3/8" DIA.
AT 24" O.C. AT BOTTOM OF CAVITY &
MIL. POLYETHYLENE BASE FLASHING
BENEATH KEEPING AND 6" UP BEHIND
BUILDING PAPER

HEAVY COAT OF BITUMEN
OVER CONC. WALL


FOUNDATION WALLS TO BE WATER
PROOFED OR PROVIDE A DRAINAGE
LAYER ADJACENT TO EXT. SURFACE OF
FOUNDATION WALL AND EXTEND TO
FOOTING LAYER OR PROVIDE SYSTEM
PLASTIC AIR GAP MEMBRANE

CEMENT COVE
4" DIA. KEEPING TILES W/1"
CRUSHED STONE COVER


CONC. FOOTING CAN FORMED KEYWAY
ON NATURAL UNDISTURBED SOIL. FOR
FOOTING SIZES SEE ARCHITECTURAL
DRAWINGS.

2 STOREY WALL SECTION


1/2" (12mm) DRYWALL FINISH OVER
CONT. 6 MIL. POLY VAPOUR/AIR
BARRIER & MIN. R-51 INSULATION
(DRYWALL ON THE CEILING ONLY
WHEN THERE IS NO SECOND
FLOOR ABOVE GARAGE)

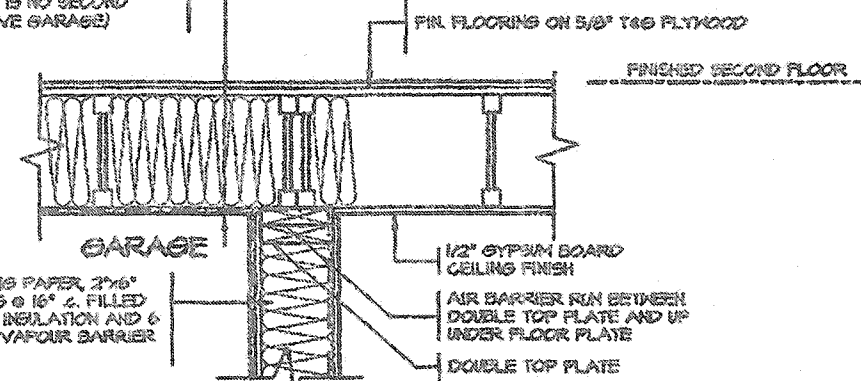

DETAIL FOR INTERIOR GARAGE WALLS & CEILINGS

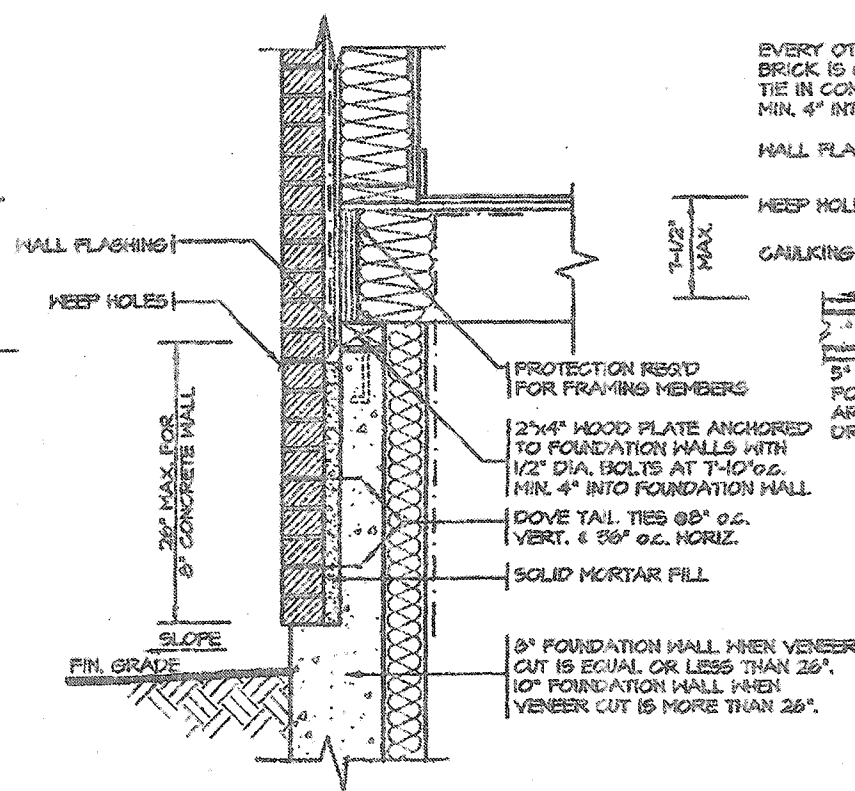

DETAIL FOR CONCRETE VENEER DROPPED GRADE

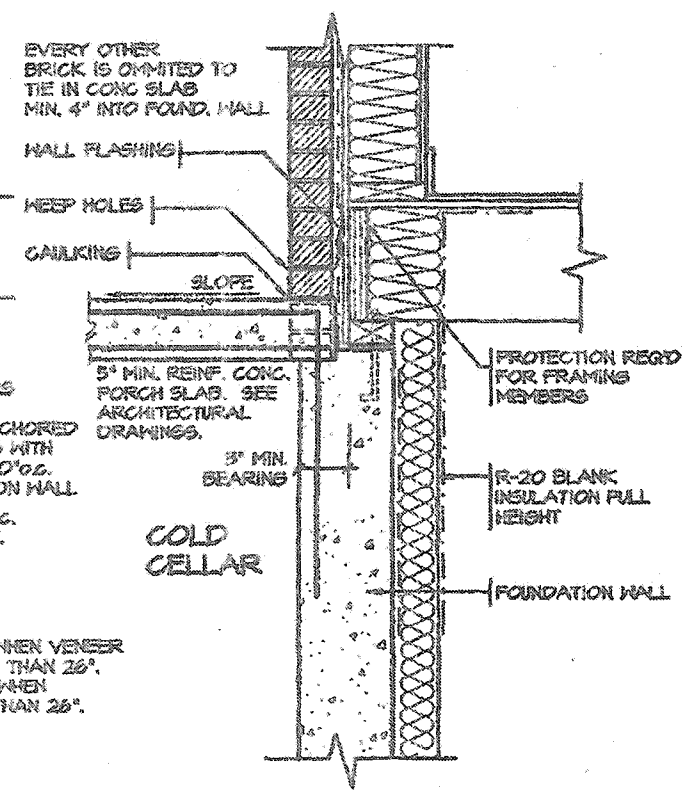

DETAIL FOR COLD CELLAR PORCH SLAB

2012 CODE COMPLIANCE PACKAGE "A1"

5.			The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 3.2.3 of the building code VIKAS GALLAR NAME SIGNATURE 28770 BCIN	REGION DESIGN INC. 8790 DUFFERIN ST. CONCORD, ONTARIO L4K 4S0 P (416) 735-4006 F (905) 860-0746	REGION DESIGN INC.	SHEET TITLE	2"x6" BRICK VENEER 2 STOREY SECTION	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.	Greenpark.	PROJECT NAME RUSSELL GARDENS III		
4.						SCALE	3/4"=1'-0"				PAGE No.	6
3.						DATE	JULY 2018					
2.												
1.	ISSUED FOR PERMIT	JUL 30, 2018										
REVISIONS												

EAVE PROTECTION SHALL BE PROVIDED FROM THE EDGE OF ROOF A MIN. 3'-0" (900mm) UP FROM THE ROOF SLOPE TO A LINE NOT LESS THAN 1'-0" (300mm) INSIDE THE INNER FACE OF THE EXTERIOR WALL. EAVE PROTECTION SHALL BE LAID BENEATH THE STARTER STRIP AND SHALL CONSIST OF TYPE 'M' OR TYPE 'B' ASPHALT COATED ROOFING SHEETS.

210 ASPHALT SHINGLES ON 5/8" PLYWOOD SHEATHING USE 'M' CLIPS FOR TRUSSES

STARTER STRIP OF ROOF SHINGLES REQUIRED

2"x6" FASCIA BOARD PREFORMED METAL GUTTER, FASCIA AND VENTED SOFFIT

1 1/2"x6" RAISED STUCCO FRIeze BACKD (TYP)

MESH BACKDRAINED

- FIN. COAT OF EXTERIOR ACRYLIC STUCCO
- FIBER MESH EMBEDDED IN PREP COAT
- INSULATION BOARD (MIN. R-5) IN GEOMETRICALLY DEFINED DRAINAGE CAVITY HAVING A MIN. CAVITY DEPTH OF 1/4"
- AIR/MOISTURE BARRIER
- 7/16" EXTERIOR GRADE OSB SHEATHING
- 2" X 6" STUDS
- MIN. R-22 BATT INSULATION
- CONT. VAPOUR / AIR BARRIER
- 1/2" DRYWALL

(IF APPROVED SYSTEM ALL MATERIALS AND SYSTEMS SHALL CONFORM TO CANALC-516.0)

CONCRETE SILL

CONTINUOUS HEADER JOIST W/ R-22 INSULATION W/ 6 MIL. VAPOUR BARRIER AND SEAL TO JOIST AND SUBFLOOR

4" FACE BRICK TIED TO STUDS WITH GALVANIZED 1/8" WIDE METAL TIES @ 16" O.C. HORIZONTAL AND 24" O.C. VERTICAL

SCREENED KEEPING HOLES 3/8" DIA. AT 24" O.C. AT BOTTOM OF CAVITY 6 MIL. POLYETHYLENE BASE FLASHING BENEATH KEEPING AND 6" UP BEHIND BUILDING PAPER

HEAVY COAT OF BITUMEN OVER CONC. WALL

FOUNDATION WALLS TO BE WATER PROOFED OR PROVIDE A DRAINAGE LAYER ADJACENT TO EXT. SURFACE OF FOUNDATION WALL AND EXTEND TO FOOTING LAYER OR PROVIDE "SYSTEM PLANTON AIR GAP MEMBRANE"

CEMENT COVE

4" DIA. KEEPING TILES W/ 1/2" CRUSHED STONE COVER

CONC. FOOTING CAN FORMED KEYWAY ON NATURAL UNDISTURBED SOIL FOR FOOTING SIZES SEE ARCHITECTURAL DRAWINGS.

2 STOREY WALL SECTION

BAFFLES AS REQUIRED FOR ROOF VENTILATION

PROVIDE ROOF VENTILATION @ A RATE OF 1:300 OF INSULATED CEILING AREA UNIFORMLY DISTRIBUTED

ROOF TRUSSES @ 24" O.C. MAX. RAISED ROOF TO MATCH PLATE

TOP OF WOOD PLATE

1/2" (12mm) DRYWALL FINISH OVER CONT. 6 MIL. POLY VAPOUR/AIR BARRIER & MIN. R-50 INSULATION

MIN. R-22 INSULATION ABOVE INNER FACE OF EXTERIOR WALL

DOUBLE TOP PLATE

1/2" GYPSUM BOARD

2"x6" BOTTOM PLATE

LAP VAPOUR AND AIR BARRIER 1/4" AND SECURE TO PLATE

FIN. FLOORING ON 5/8" T&G PLYWOOD

FINISHED SECOND FLOOR

PARALLEL JOISTS, 12" WOOD BLOCKING @ 36" O.C.

FLOOR JOISTS SEE PLAN

1/2" GYPSUM BOARD CEILING FINISH

SINGLE CONT. TIMBERSTRAND

AIR BARRIER RUN BETWEEN DOUBLE TOP PLATE AND UP UNDER FLOOR PLATE

DOUBLE TOP PLATE

1/2" GYPSUM BOARD

SINGLE CONTIN. TIMBERSTRAND

FIN. FLOORING ON 3/4" T&G PLYWOOD

FINISHED FIRST FLOOR

CAULK OR SEAL WITH GASKET

AIR BARRIER SEALED TO PLATE

2"x4" WOOD PLATE ANCHORED TO FOUNDATION WALLS WITH 1/2" DIA. BOLTS AT 7'-0" O.C. MIN. 4" INTO FOUNDATION WALL


R-20 BLANKET INSULATION DOWN WITHIN 2" MIN. AND 8" MAX. ABOVE FINISH SLAB WITH MOISTURE & VAPOUR BARRIER SEALED AT TOP & BOTTOM

POURED CONC. FDN. WALL FOR WALL THICKNESS SEE ARCHITECTURAL DRAWINGS.

CONTINUOUS WATERSTOP (BITUMEN CAULKING)

8" CONCRETE SLAB 25 MPa ON 4" MIN. COMPACT GRAVEL

FINISHED SLAB

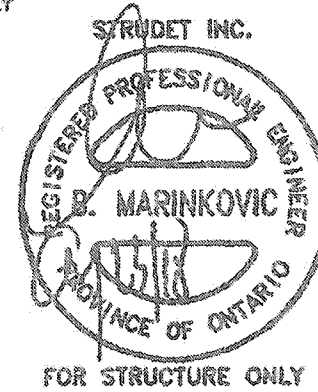

FOR STRUCTURE ONLY

WOOD SHEATHING

AIR/MOISTURE BARRIER

FIBER MESH EMBEDDED IN PREP COAT

INSULATION BOARD (R-5) IN GEOMETRICALLY DEFINED DRAINAGE CAVITY HAVING A MIN. CAVITY DEPTH OF 1/4"

STARTER MESH (BACKDRAINED)

CAULK WITH BEAD VENT


FLASHING

CONCRETE SILL

MASONRY GLADDING AS PER ELEVATION

A. TERMINATION AT MASONRY GLADDING WITH SEALANT

1 1/2" = 1'0"

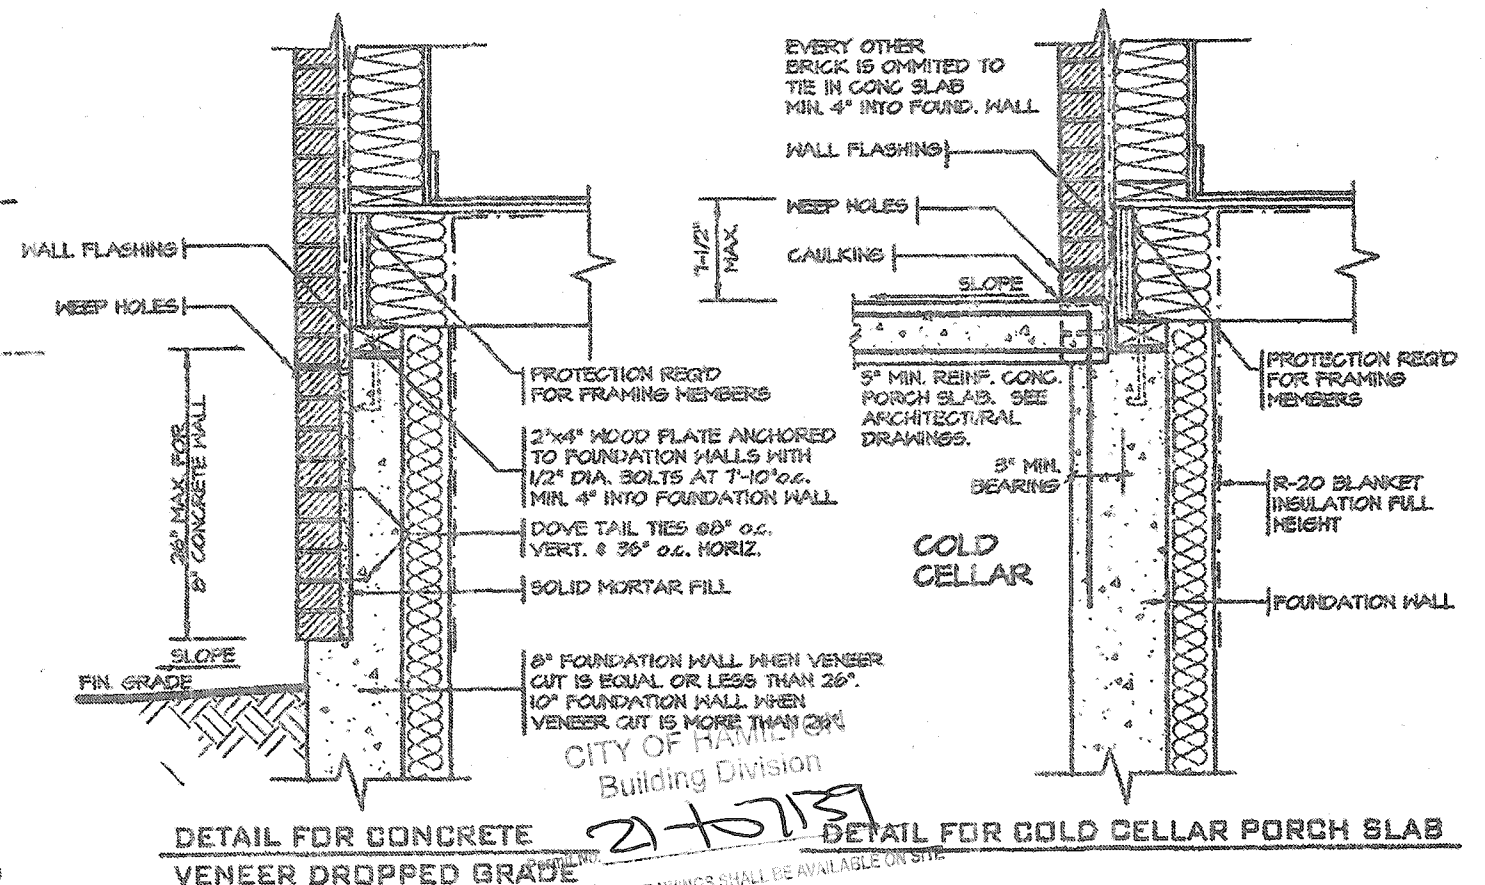

DETAIL FOR CONCRETE VENEER DROPPED GRADE





DETAIL FOR COLD CELLAR PORCH SLAB

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
FOR CHIEF BUILDING OFFICIAL
DATE 1/21

2012 CODE COMPLIANCE PACKAGE "A1"

5. _____ 4. _____ 3. _____ 2. _____ 1. ISSUED FOR PERMIT JUL 30, 2018 REVISIONS	The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 9.2.5 of the building code VIKAS GAJJAR 28770 NAME SIGNATURE BCIN	REGION DESIGN INC. 8700 DUFFERIN ST. CONCORD, ONTARIO L4K 4G8 P (416) 738-4098 F (905) 660-0745	SHEET TITLE 2"x6" STUCCO WALL 2 STOREY SECTION SCALE AS NOTED DATE JULY 2018	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED. PROJ. No. 6-2	PROJECT NAME RUSSELL GARDENS III
---	--	---	---	--	--




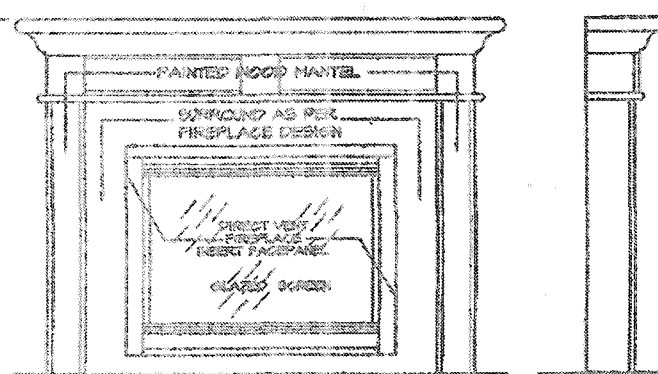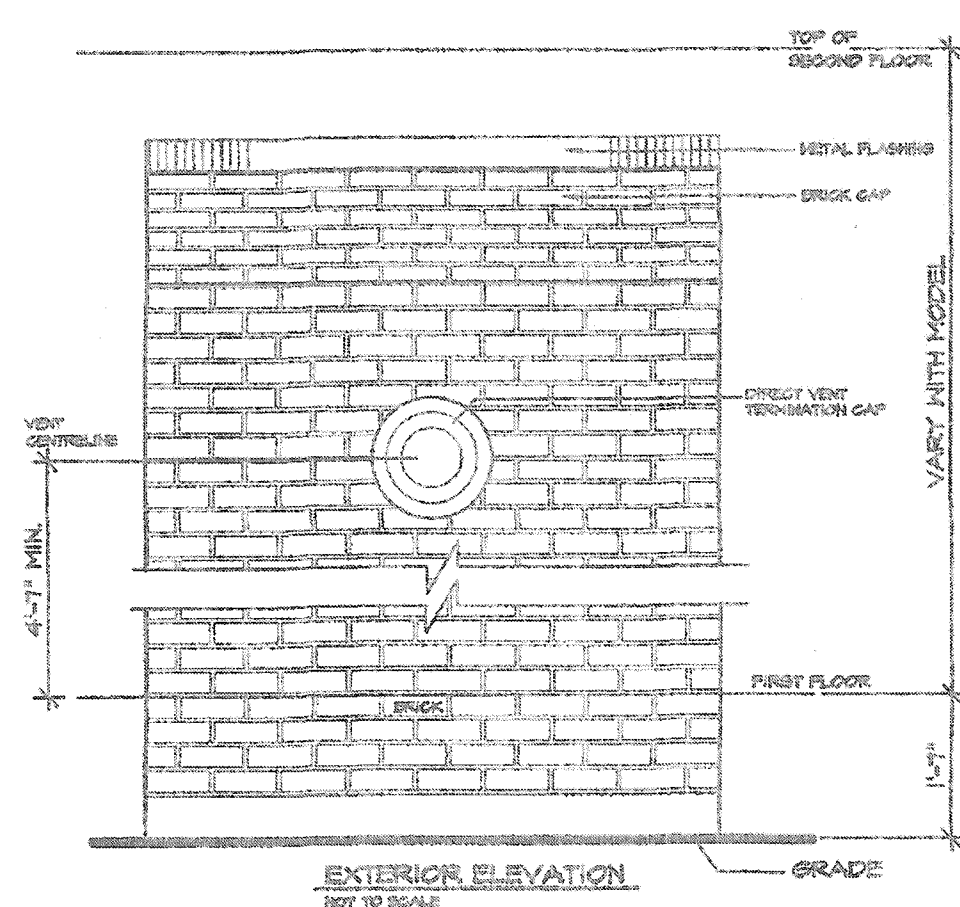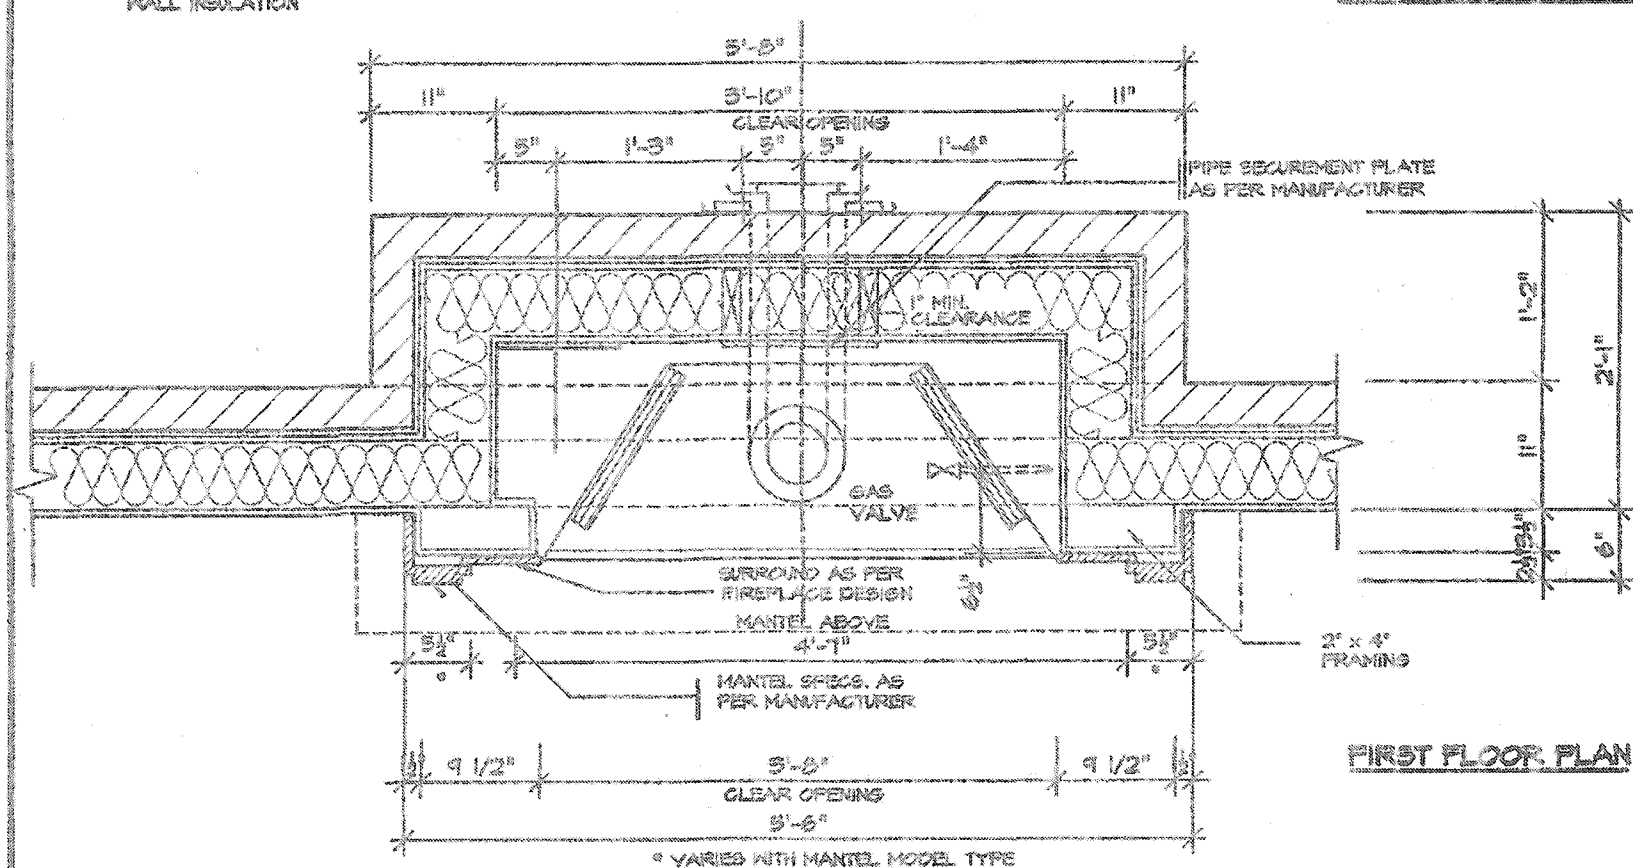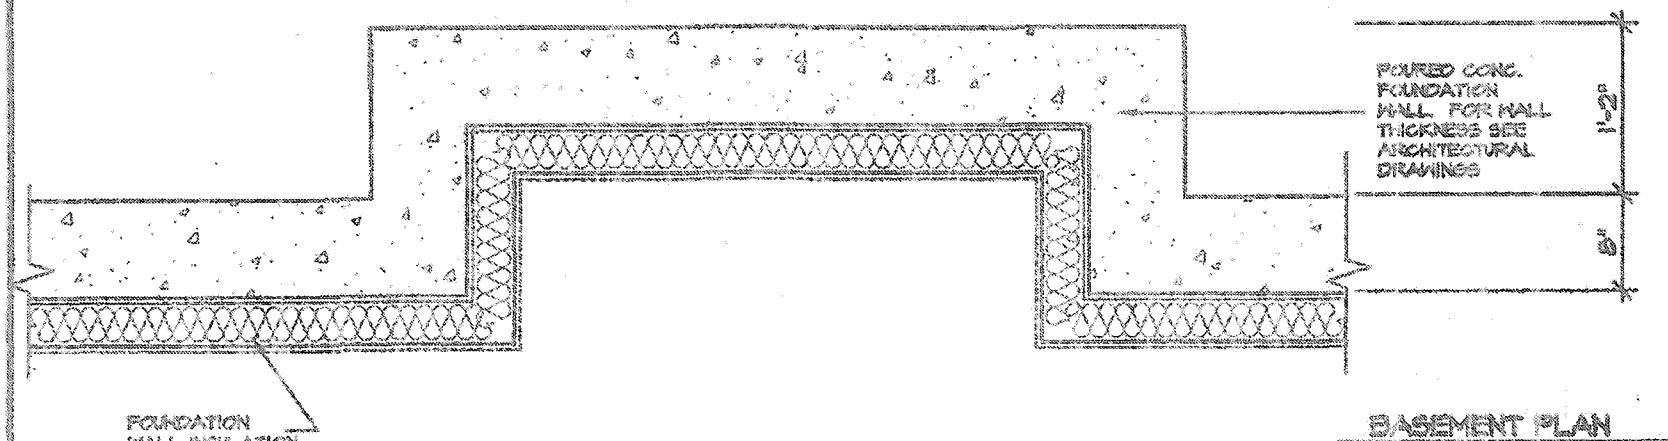

FRONT/SIDE ELEVATION
NOT TO SCALE









GENERAL INSTALLATION NOTES

- 1.0 UNIT INSTALLATION TO STRICTLY CONFORM TO MANUFACTURER'S INSTALLATION MANUAL AND ALL APPLICABLE CODES OF LOCAL AUTHORITIES HAVING JURISDICTION INCLUDING CAN/CSA-3441.1 & 2.
- 2.0 INSTALL WITH THE FOLLOWING MINIMUM CLEARANCES TO COMBUSTIBLES:
 - FROM TOP OF UNIT 0"
 - FROM BACK OF UNIT 1/2"
 - FROM SIDES OF UNIT 1/2"
 - FROM TOP OF HORIZONTAL 8"
 - FROM SIDES TO VENT 1"
- 3.0 THE DIRECT VENT UNIT ILLUSTRATED IS THE ECOBO MODEL AS MANUFACTURED BY HEATILATOR.
- 4.0 THE MANTEL ILLUSTRATED IS THE 5-2 60 AS SUPPLIED BY GREATER TORONTO FIREPLACE.

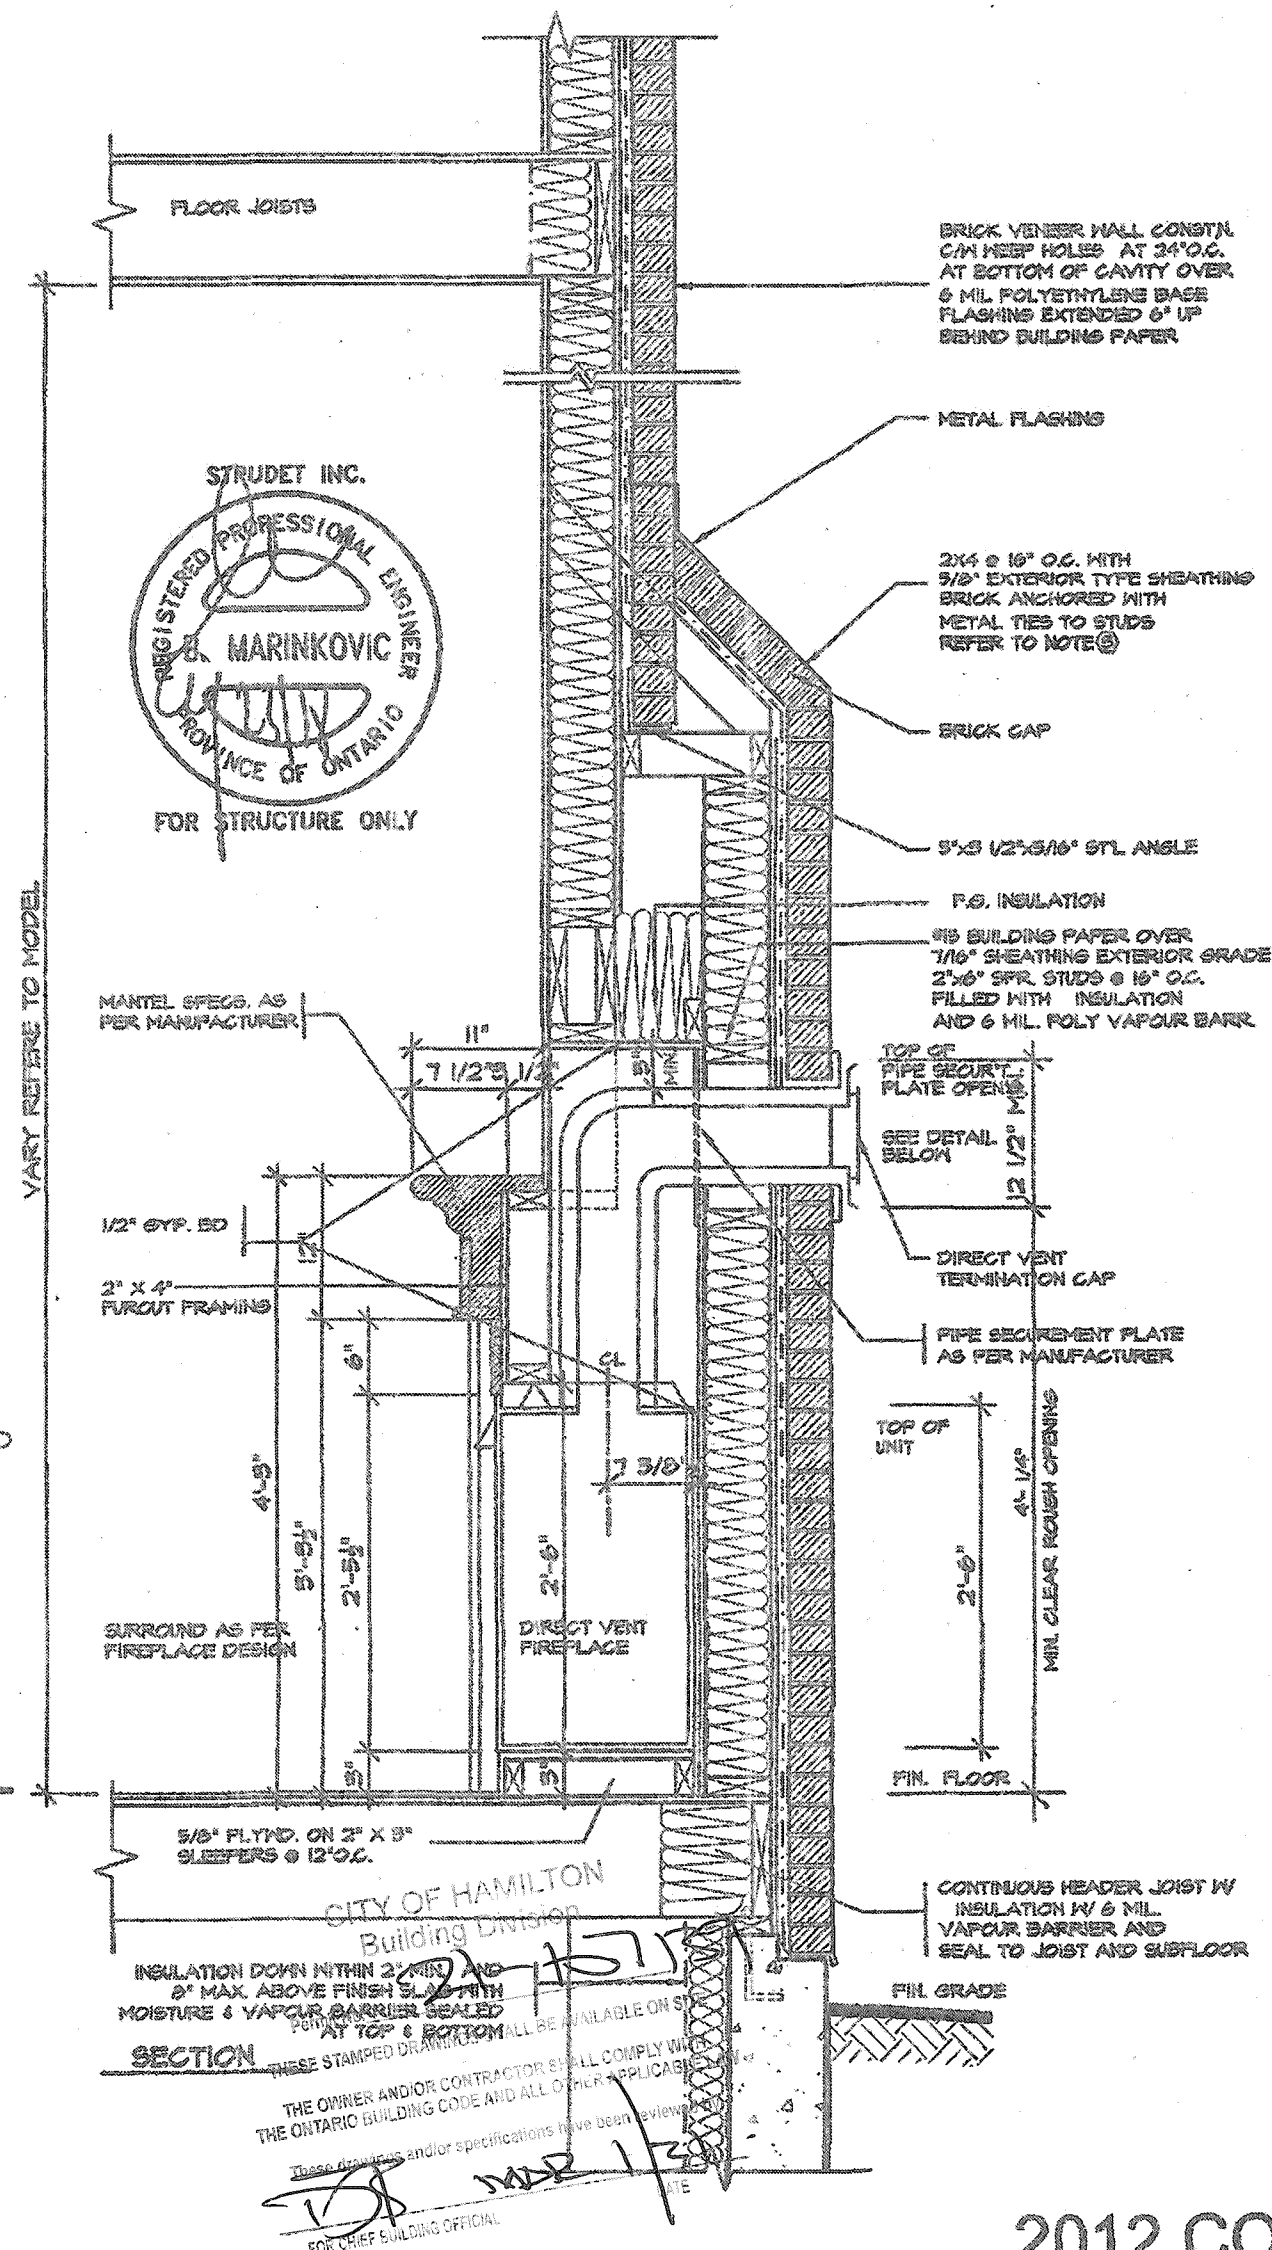

2012 CODE COMPLIANCE PACKAGE "A1"

5. _____ 4. _____ 3. _____ 2. _____ 1. ISSUED FOR PERMIT JUL 30, 2018 REVISIONS	The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required under Ontario Regulation 61, 2015, Section 2.2.5 of the building code VIKAS GAJJAR <i>[Signature]</i> 28770 NAME SIGNATURE BCIN	REGION DESIGN INC. 8700 DUFFERIN ST. CONCORD, ONTARIO L4K 1B6 P (416) 730-4008 F (905) 860-0746 REGION DESIGN INC.	SHEET TITLE VENT FIREPLACE DIRECT SCALE 3/4"=1'-0" DATE JULY 2018	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED. PAGE No. 7-2	Greenpark. PROJECT NAME RUSSELL GARDENS III
--	--	--	---	--	--

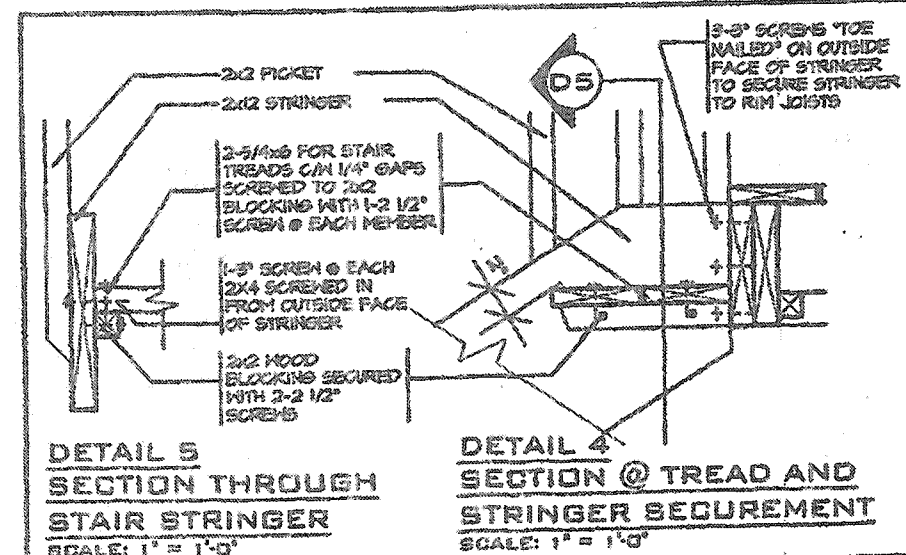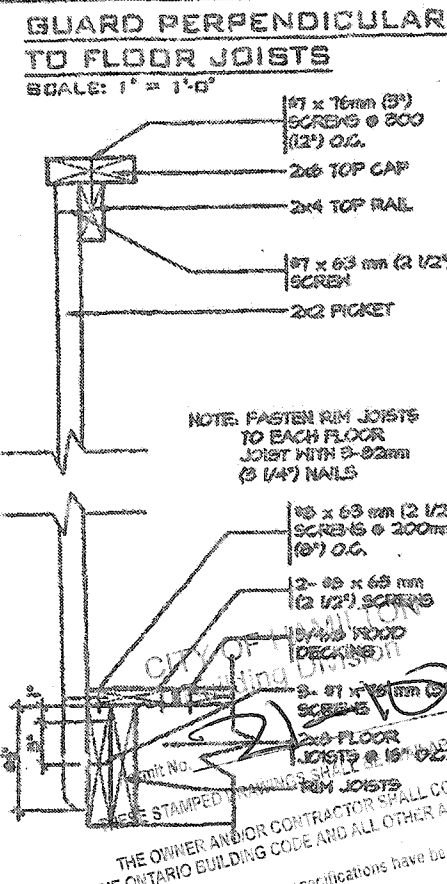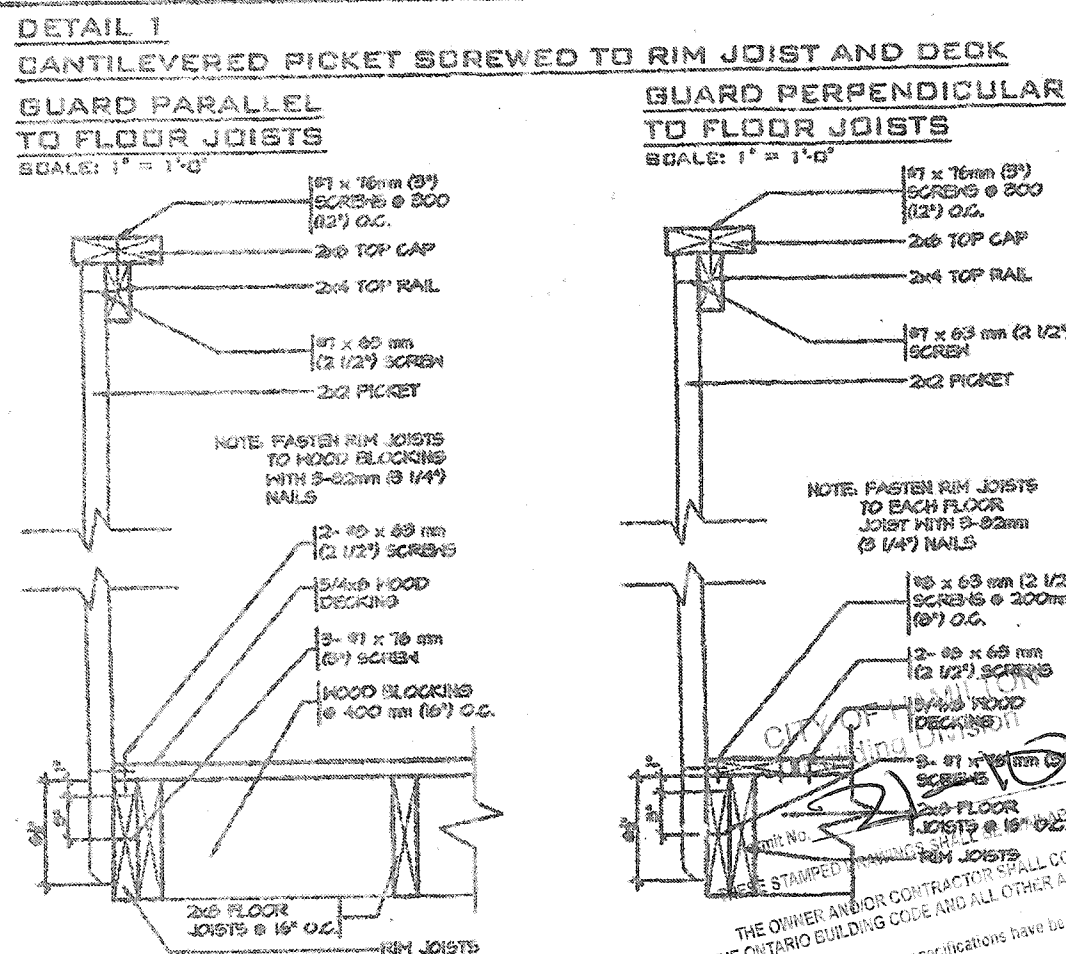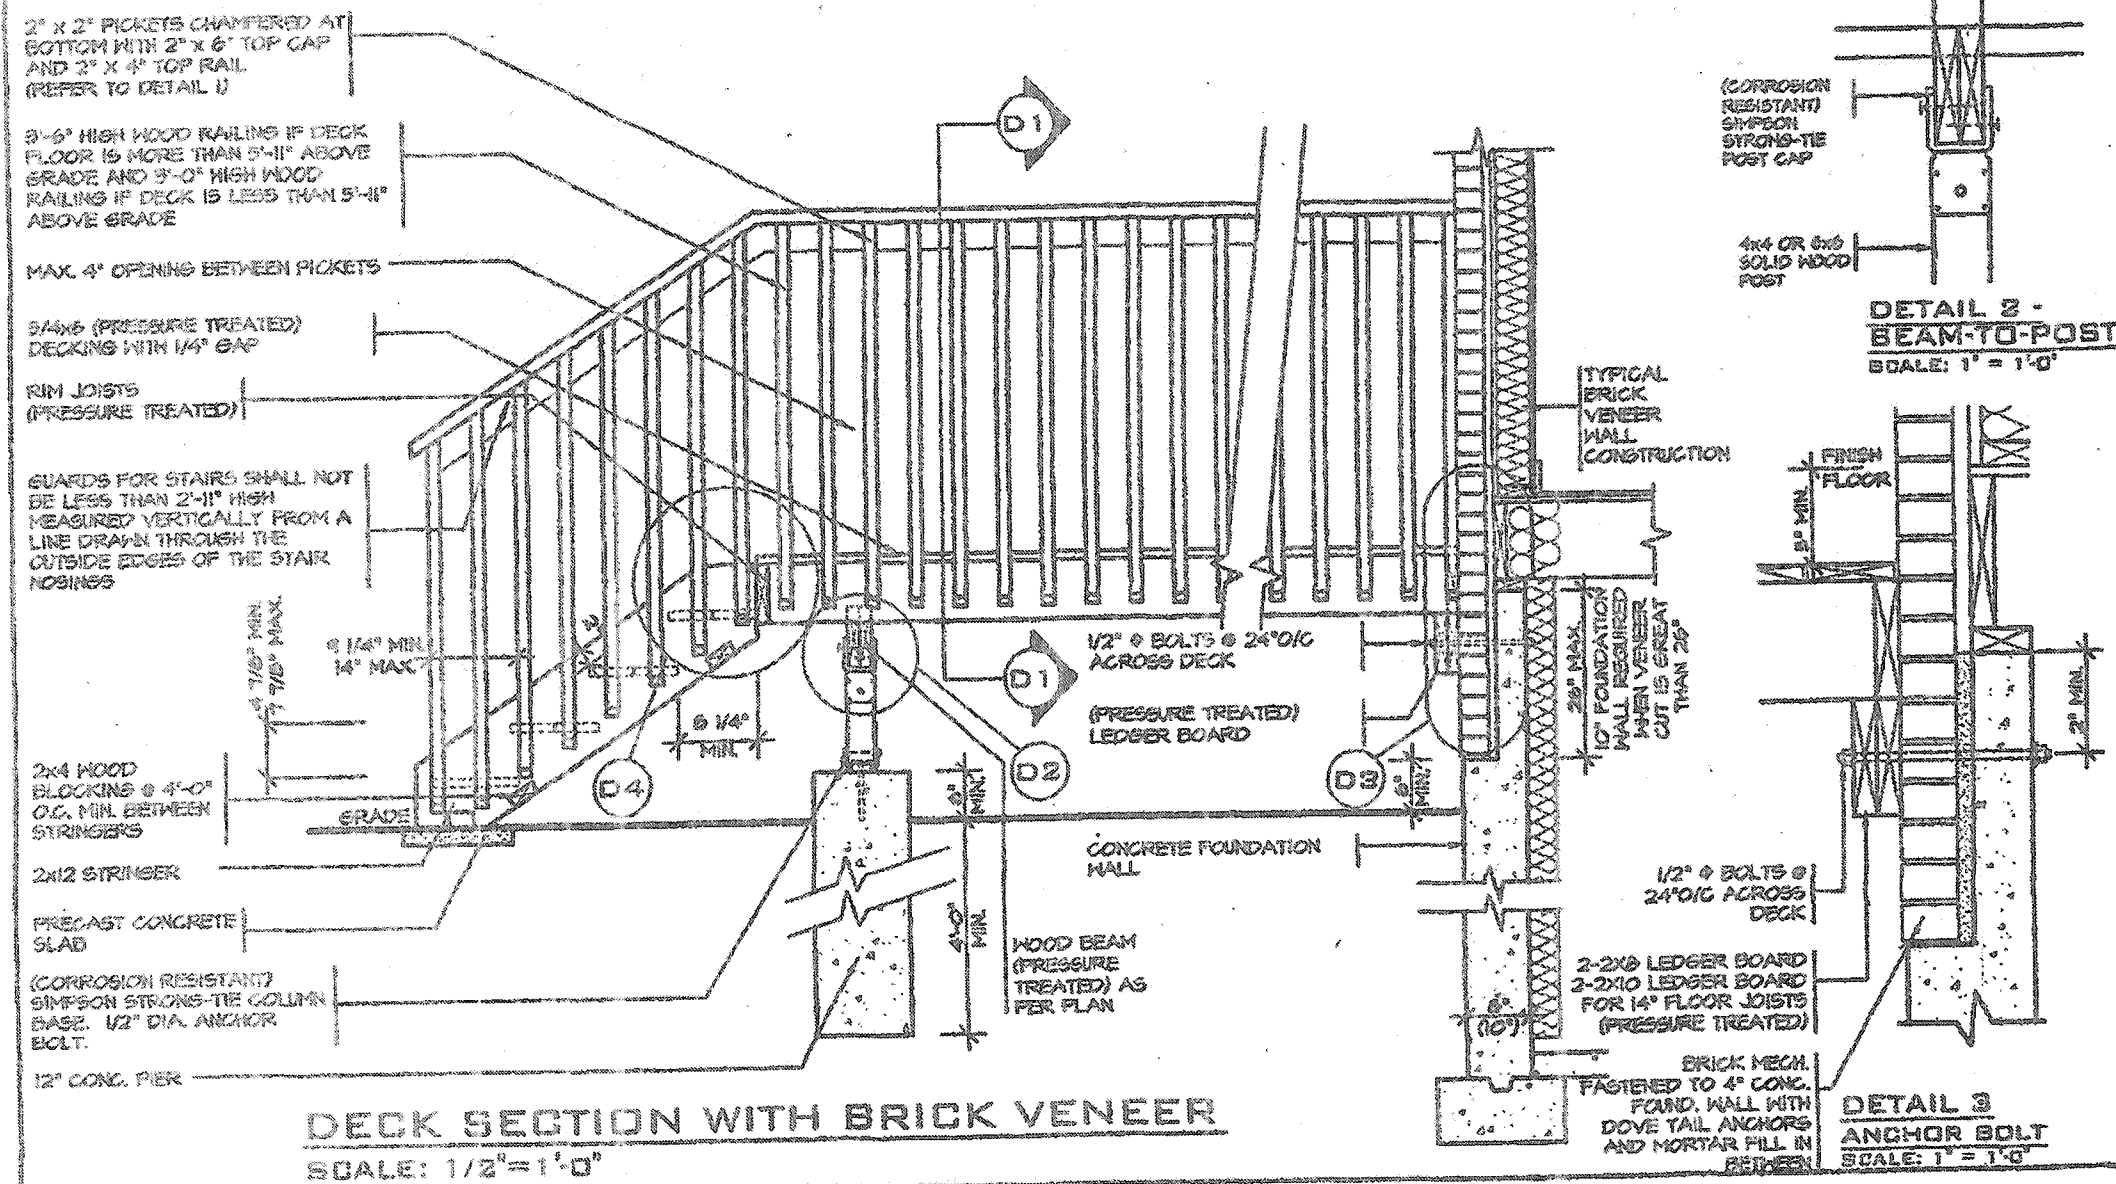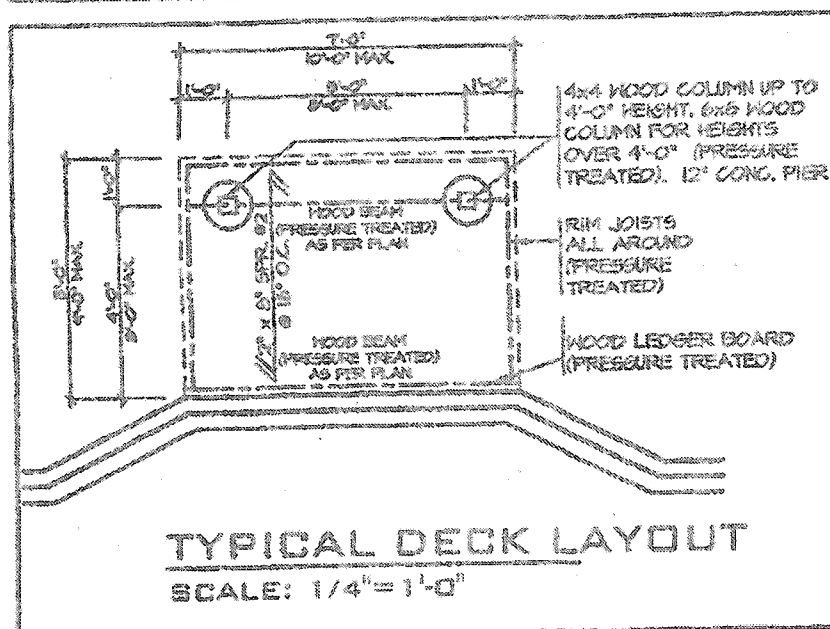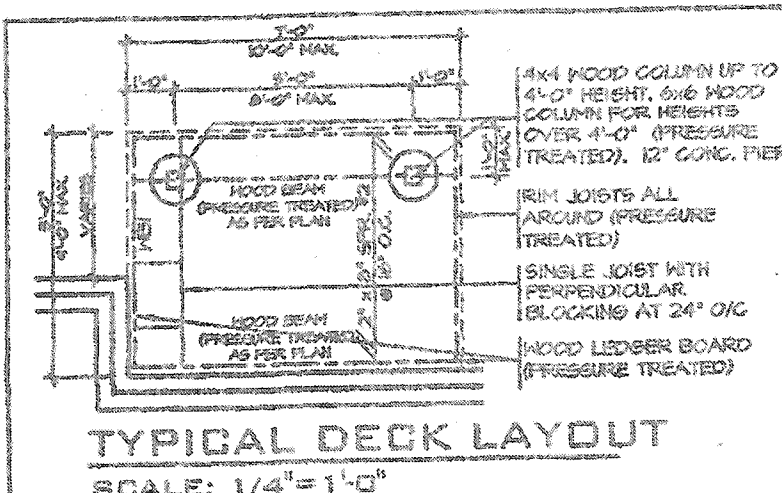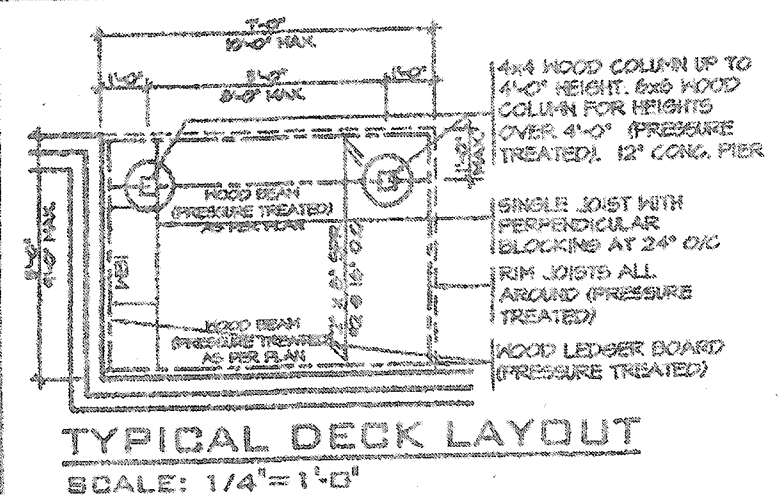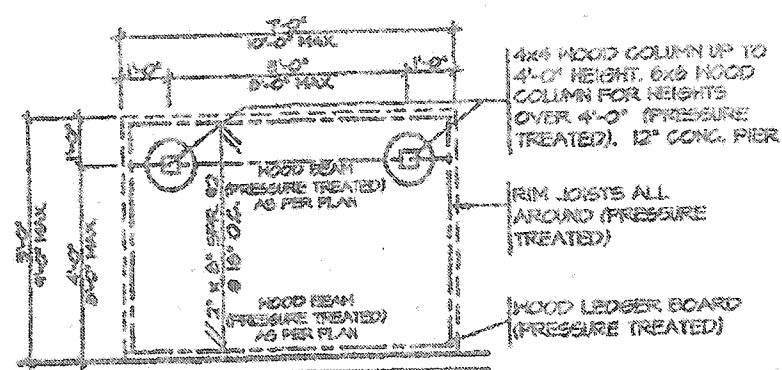

GENERAL NOTES

1. BRICK TO BE COMPRESSIVE STRENGTH OF 15 MPa (2200 psi) MIN. UNITS TO BE LAID WITH FULL REND AND BED JOINTS.
2. MORTAR TO BE TYPE S WITH JOINT THICKNESS OF 10mm (3/8") MIN. AND 20mm (3/4") MAX.
3. ALL NAILS AND SCREWS TO BE GALVANIZED.
4. WOOD FOR CANTILEVERED PICKETS SHALL BE DOUGLAS FIR-LARCH, SPRUCE-PIKE-FIR, OR MEM-FIR SPECIES.

STRUDET INC.

REGISTERED PROFESSIONAL ENGINEER

8 MARINKOVIC


PROVINCE OF ONTARIO

ONLY

2012 CODE

COMPLIANCE PACKAGE "A1"

6.		The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 9.2.5 of the building code VIKAS GAJJAR  28770 NAME SIGNATURE BCIN	REGION DESIGN INC. 8700 SUFFERIN ST. COXCOOR, ONTARIO L4K 4S8 P (910) 736-4096 F (905) 660-0746	REGION DESIGN INC.	SHEET TITLE		WOOD DECK DETAIL		CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.		 PROJECT NAME RUSSELL GARDENS III		
5.					SCALE	AS SHOWN	BY		AREA			PAGE NO.	8
4.					DATE	NOV 2016	TYPE		PROJECT	00-00-00			
3.													
2.													
1.	REVISED FOR STARTIME	NOV 16	REVISIONS										

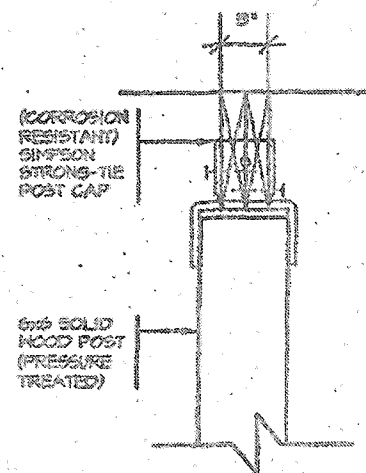

**DETAIL 2 -
BEAM-TO-POST**
SCALE: 1" = 1'-0"

2x2 PICKETS CHAMFERED AT BOTTOM WITH 2x6 TOP CAP AND 2x4 TOP RAIL (REFER TO DETAIL 1)

3'-6" HIGH WOOD RAILING IF DECK FLOOR IS MORE THAN 5'-4" ABOVE GRADE AND 3'-0" HIGH WOOD RAILING IF DECK IS LESS THAN 5'-4" ABOVE GRADE

MAX. 4" OPENING BETWEEN PICKETS



5/16" (PRESSURE TREATED) DECKING WITH 1/4" GAP

DOUBLE RIM JOISTS (PRESSURE TREATED)

WOOD BEAM AS PER PLAN (PRESSURE TREATED)

(CORROSION RESISTANT) SIMPSON STRONG-TIE POST CAP

(CORROSION RESISTANT) SIMPSON STRONG-TIE COLUMN BASE 1/2" DIA. ANCHOR BOLT.

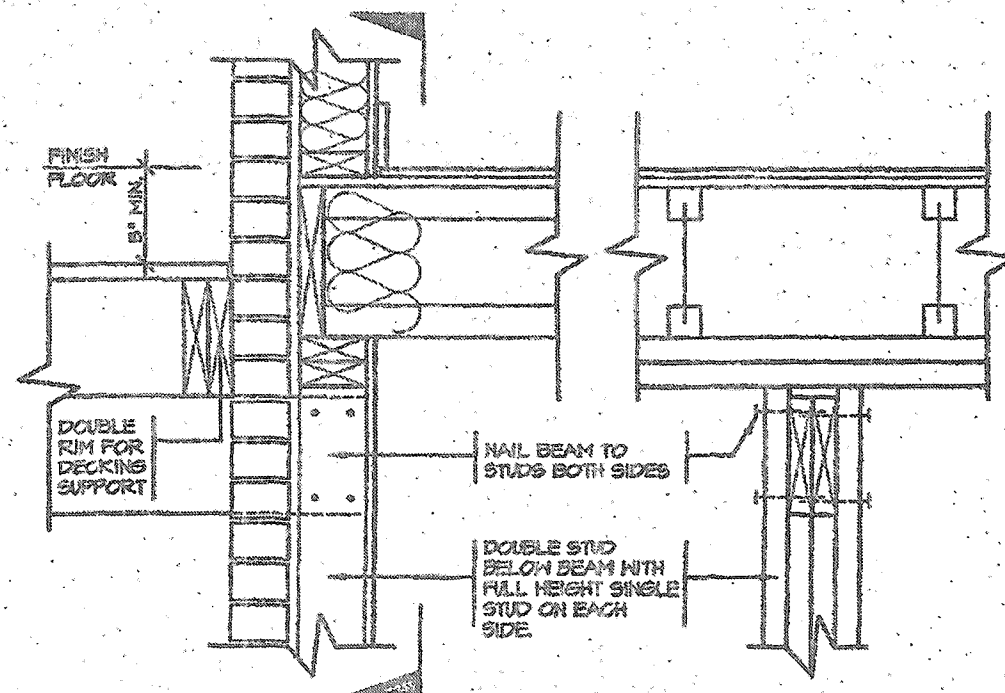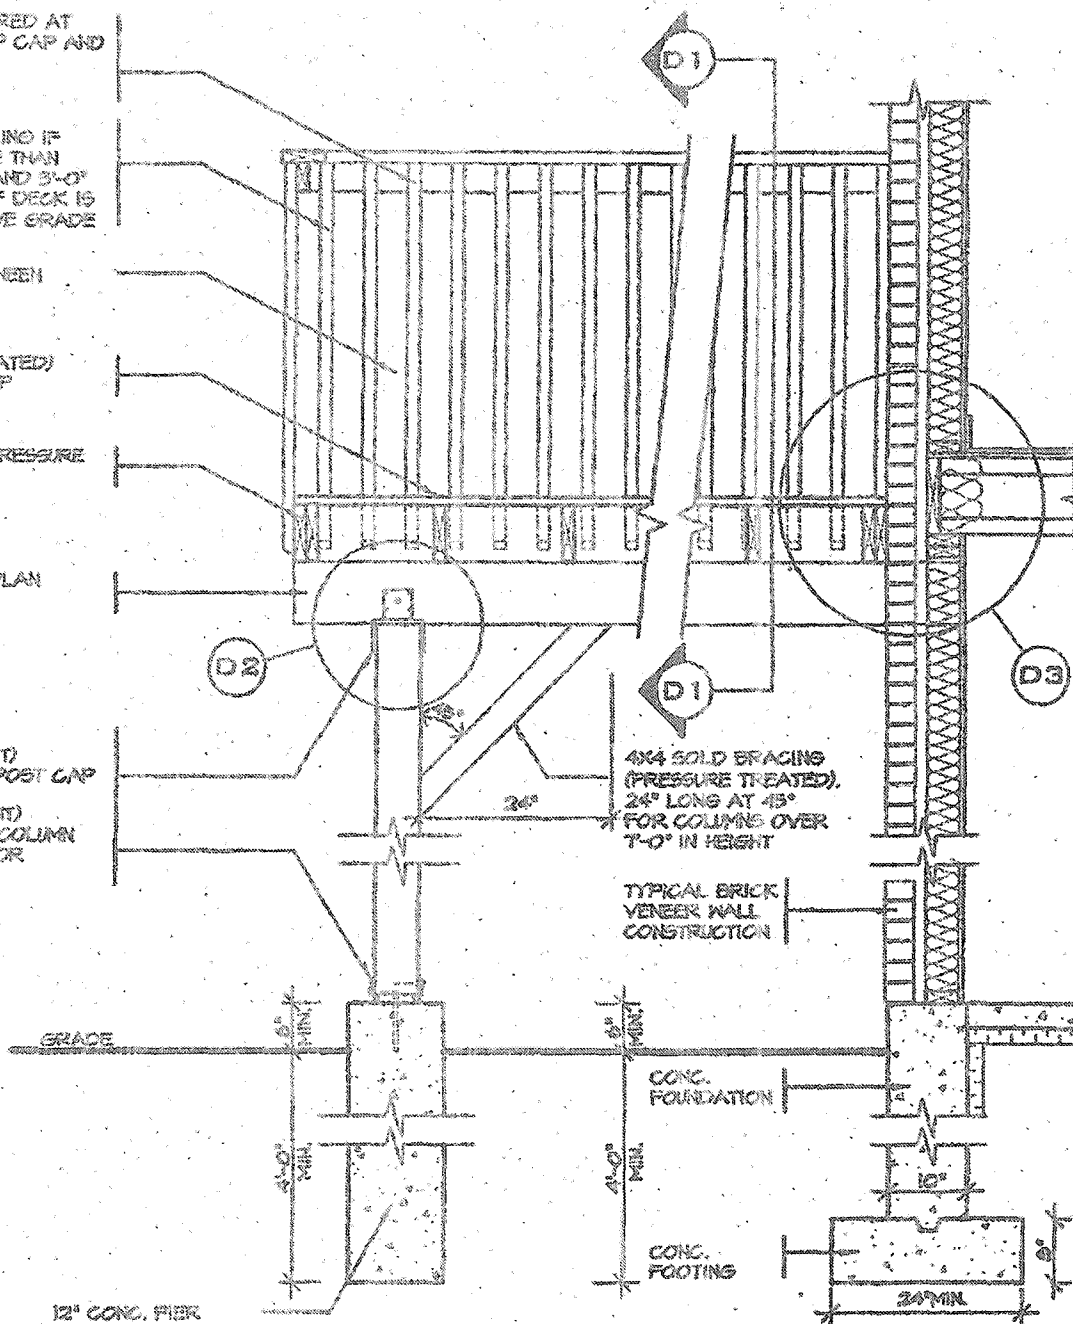

**DETAIL 3 -
BEAM-TO-STUD WALL**
SCALE: 1" = 1'-0"

DECK SECTION WITH BRICK VENEER
SCALE: 1/2" = 1'-0"

CITY OF HAMILTON
Building Division

Permit No. **21-157139**

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW


These drawings and/or specifications have been reviewed by

[Signature] DATE **1/21**


FOR CHIEF BUILDING OFFICIAL

**DETAIL 1
CANTILEVERED PICKET SCREWED TO RIM JOIST AND DECK**

GUARD PARALLEL TO FLOOR JOISTS
SCALE: 1" = 1'-0"

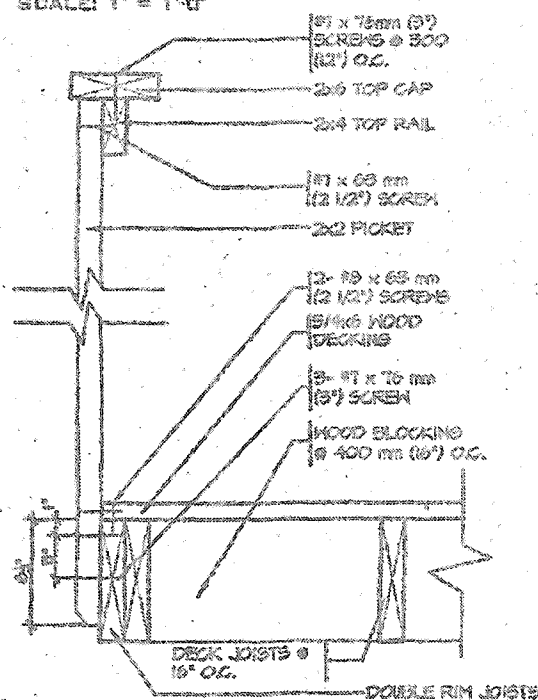

GUARD PERPENDICULAR TO FLOOR JOISTS
SCALE: 1" = 1'-0"

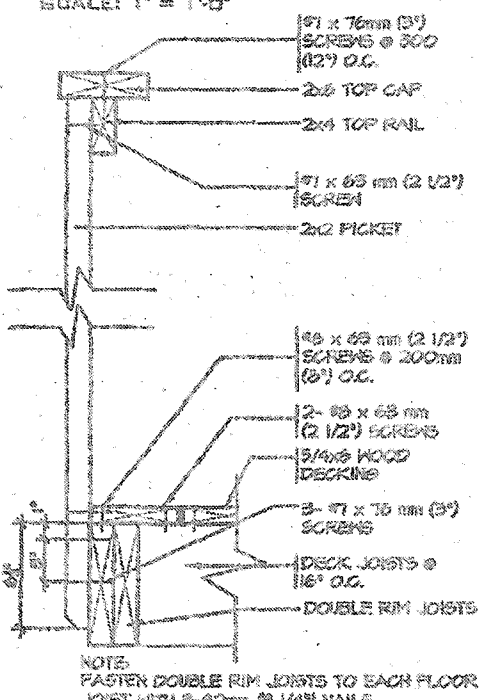


NOTE: PASTER DOUBLE RIM JOISTS TO EACH FLOOR JOIST WITH 5-92mm (3 1/4") NAILS

GENERAL NOTES

1. THE DECK HAS BEEN DESIGNED TO SAFELY SUPPORT A SUPERIMPOSED LOAD OF 1.4kPa (40psf)
2. ALL NAILS AND SCREWS TO BE GALVANIZED
3. WOOD FOR CANTILEVERED PICKETS PICKETS SHALL BE DOUGLAS FIR-LARCH, SPRUCE-FINE-FIR, OR HEM-FIR SPECIES
4. CONCRETE SHALL HAVE COMPRESSIVE STRENGTH OF 20MPa AT 28 DAYS AND 5-8% AIR ENTRAINED
5. FOOTING TO BE PLACED ON UNDISTURBED SOIL WITH MIN. BEARING PRESSURE OF 150KPa (3300psf)

MAR 08 2018

FOR STRUCTURE ONLY
2012 CODE
COMPLIANCE PACKAGE "A1"

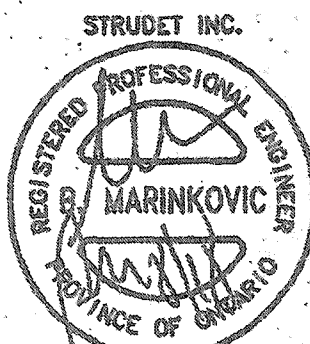

REVISIONS	DATE
1. REVISED FOR RUSSELL GARDENS	MAR 2018

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION

Required unless design is exempt under Division C, Subsection 3.2.5 of the Building Code

VIKAS GAJJAR
NAME
28770
BCIN

[Signature]
SIGNATURE

REGION DESIGN INC.
6700 DUFFERIN ST.
CONDOR, ONTARIO
L4K 4S6
P (416) 735-4096
F (605) 600-0746

SHEET TITLE
**WALK-OUT
DECK DETAILS**

SCALE
AS SHOWN

DATE
MAR 2018


CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.

AREA
PAGE No.
8-2

PROJECT
00-00-00

Greenpark.

PROJECT NAME
RUSSELL GARDENS III

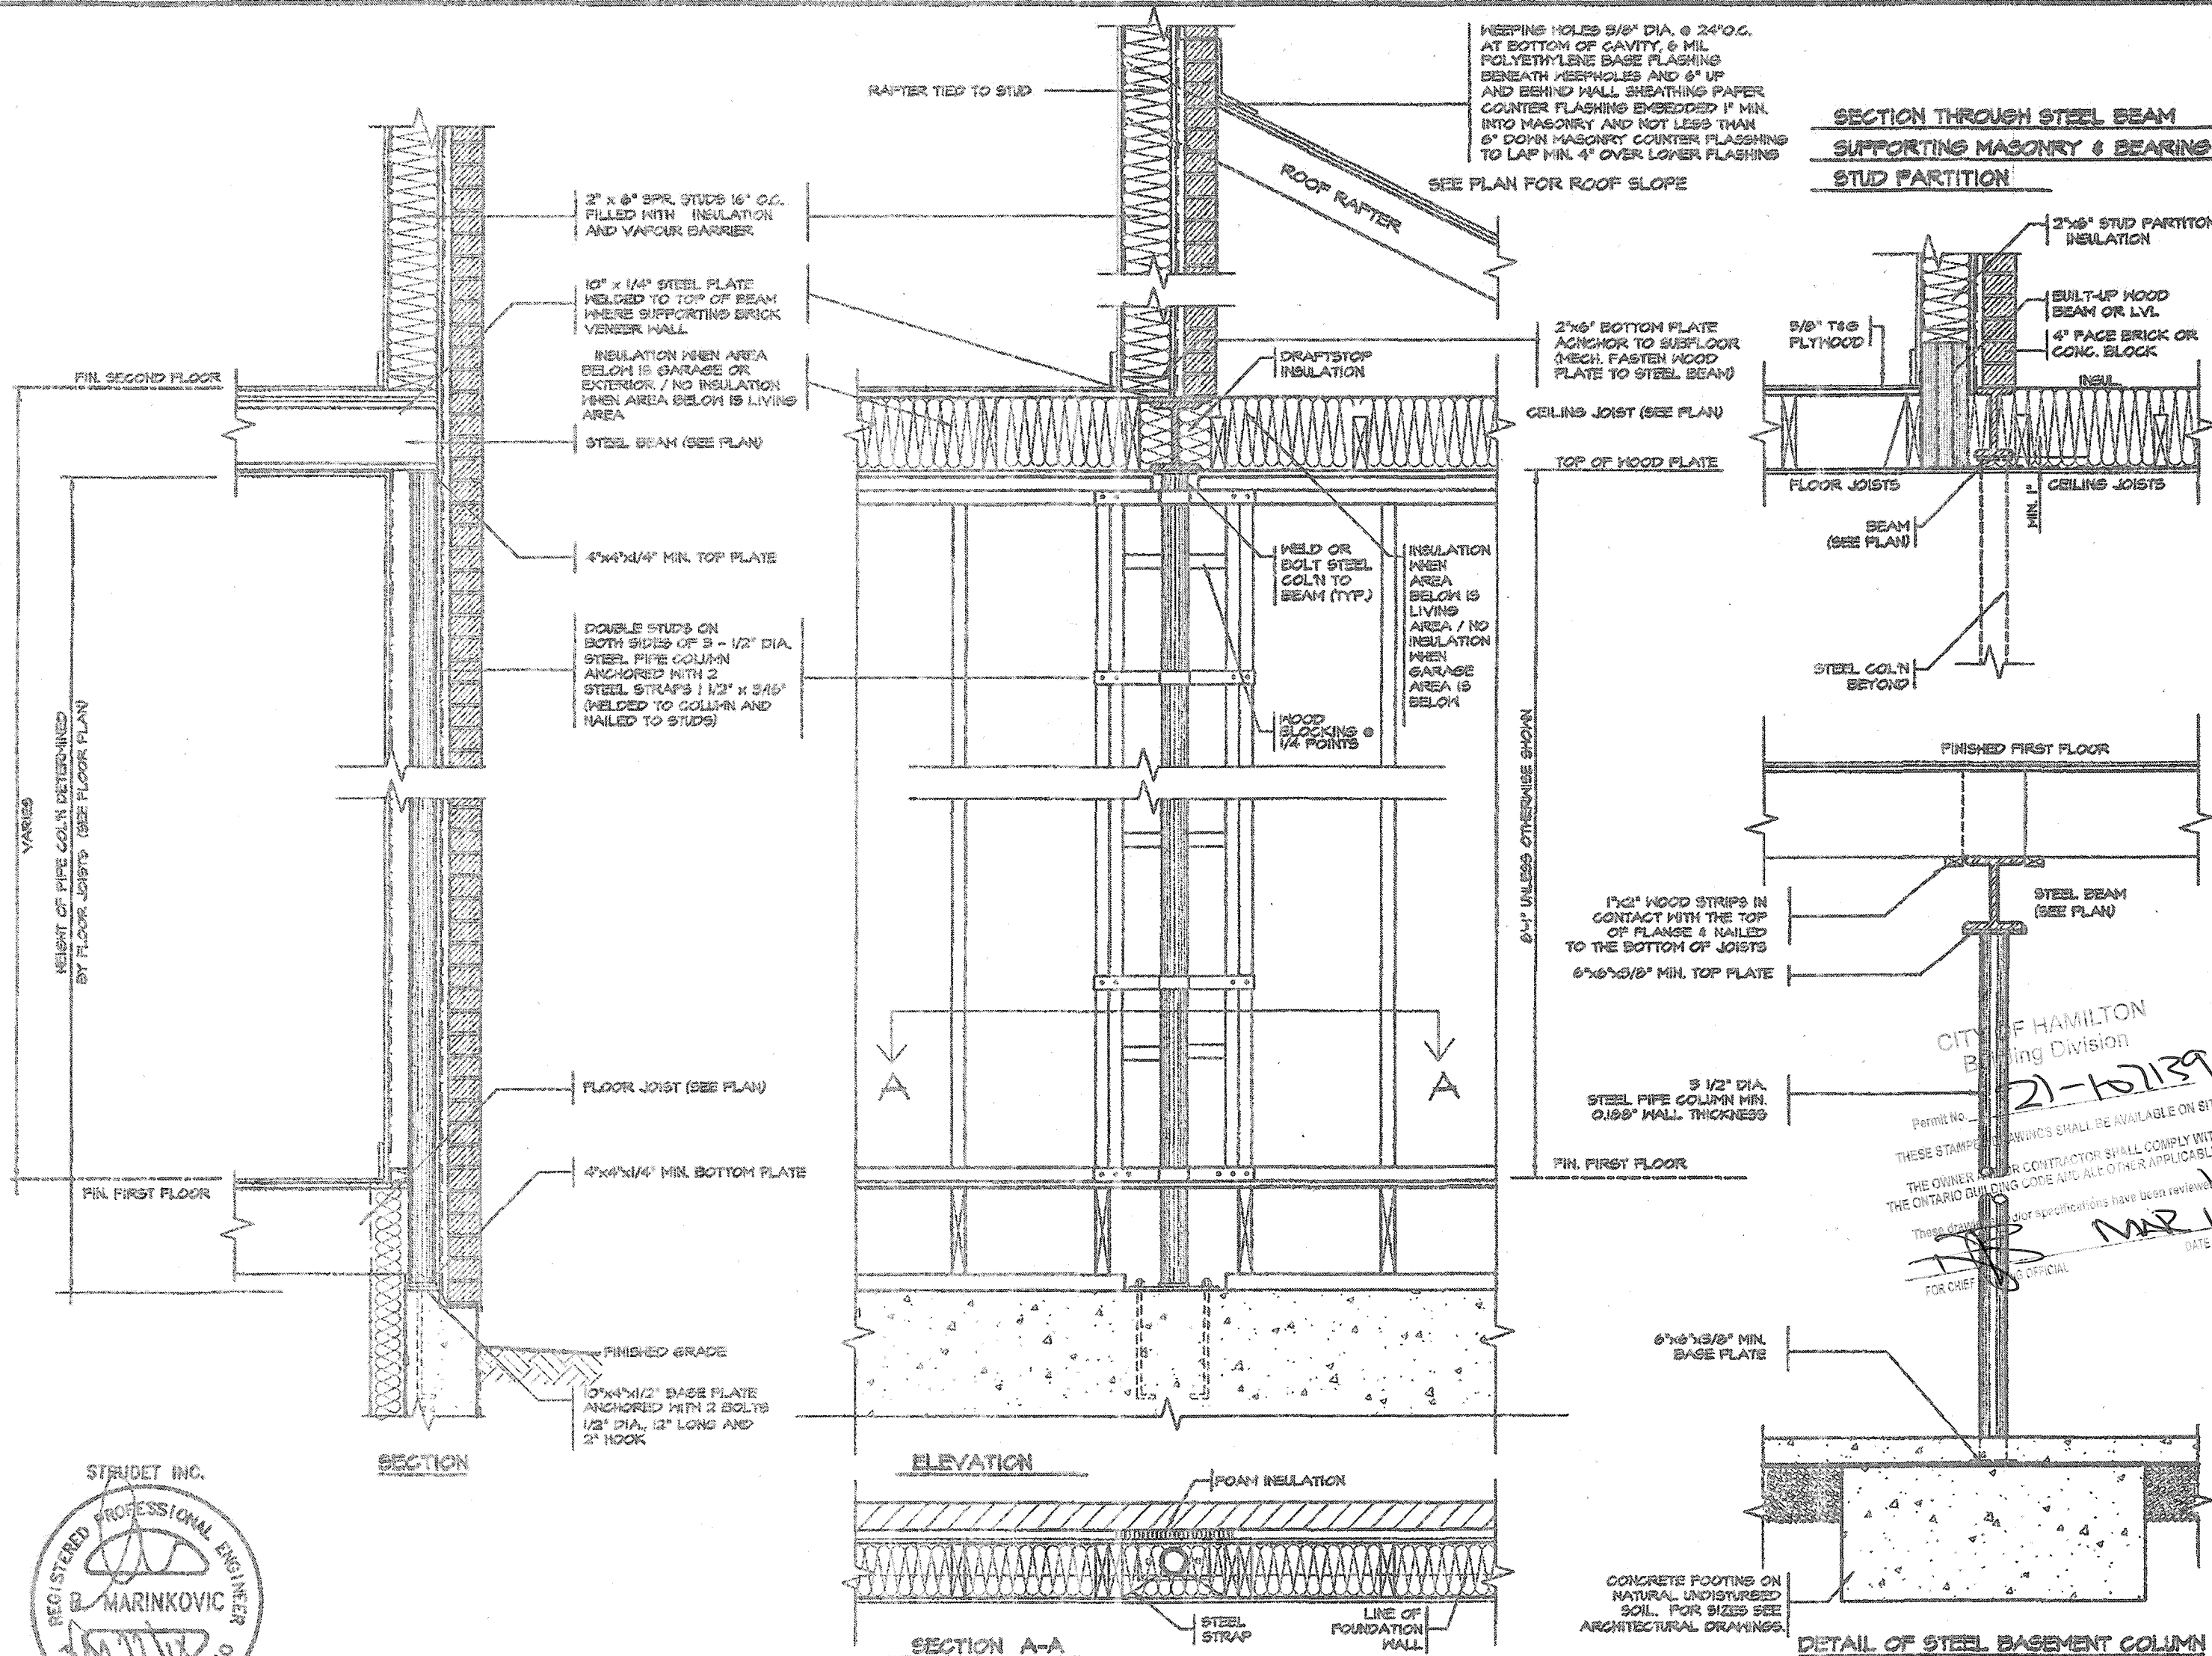


2012 CODE COMPLIANCE PACKAGE "A1"




5. 4. 3. 2. 1. ISSUED FOR PERMIT JUL 30, 2016 REVISIONS	The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 3.2.5 of the building code VIKAS GAJJAR NAME 28770 SIGNATURE BCIN	REGION DESIGN INC. 8700 DUFFERIN ST. CONCORD, ONTARIO L4K 4S8 P (416) 758-4008 F (905) 608-0740	REGION DESIGN INC.	SHEET TITLE COLUMN DETAILS STEEL SCALE 3/4"=1'-0" DATE JULY 2016	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED. PAGE NO. 9	Greenpark. PROJECT NAME RUSSELL GARDENS III
--	--	--	--	---	---	--

11-0452 AM STANDARD DETAILS PERMIT SE 1201741 PACKAGE (MUNICIPALITY) 9 - STEEL COLUMN DETAILS PACKAGE A1.DWG July 30, 2016

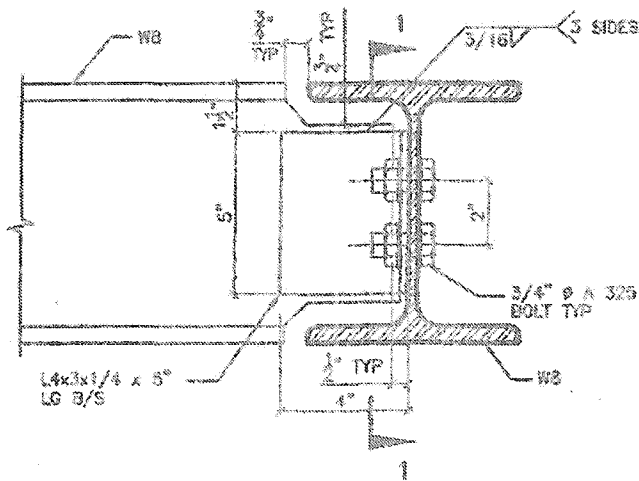


DETAIL 1.

W8
TO
W8
CONNECTION

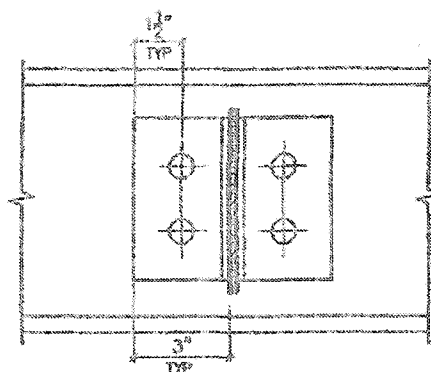


SECTION 1-1

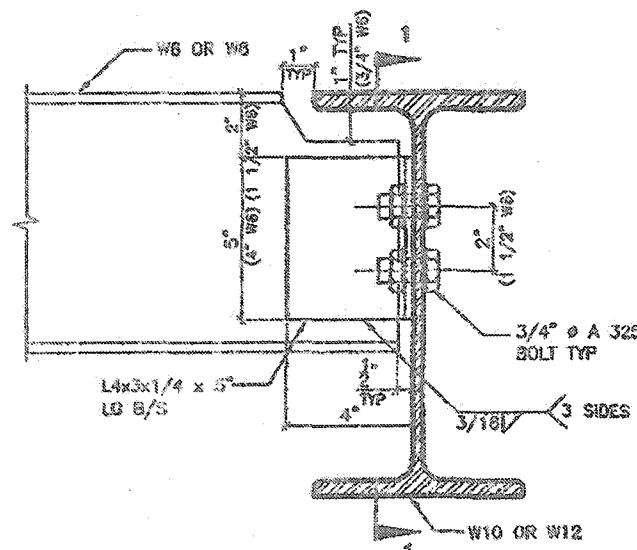


DETAIL 2.

W6(W8)
TO
W10(W12)
CONNECTION

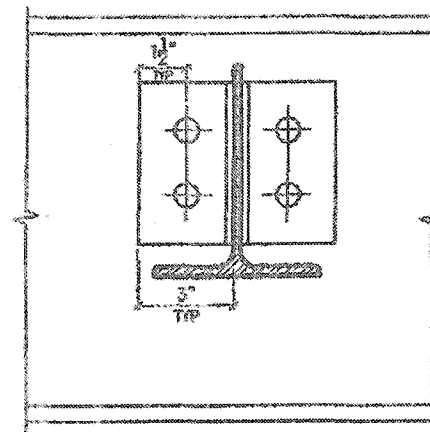


SECTION 1-1

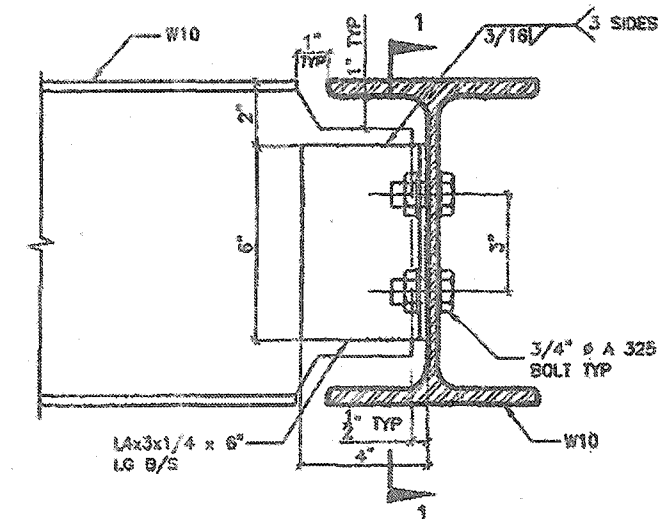


DETAIL 3.

W10
TO
W10
CONNECTION

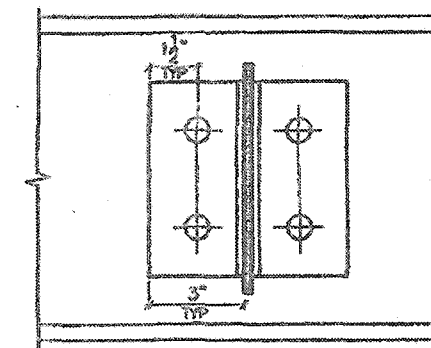


SECTION 1-1

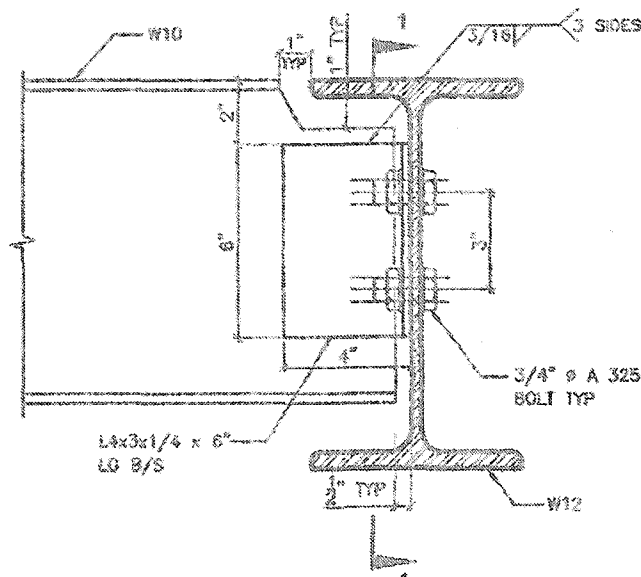


DETAIL 4.

W10
TO
W12
CONNECTION

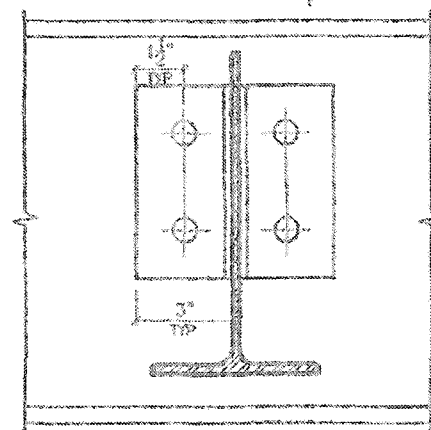


SECTION 1-1

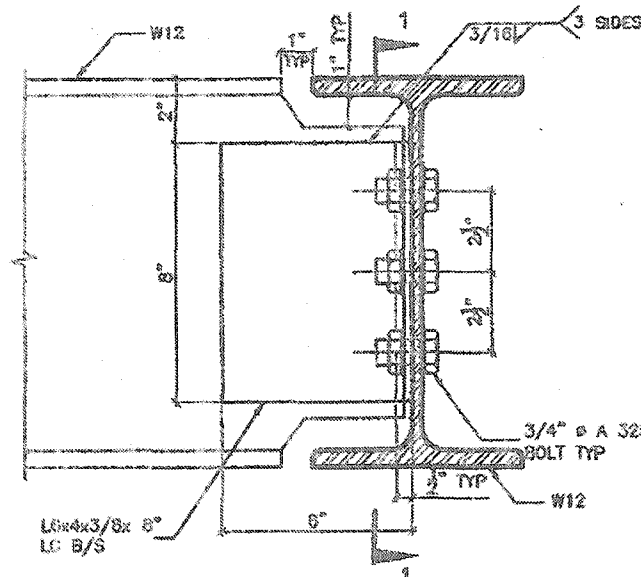


DETAIL 5.

W12
TO
W12
CONNECTION

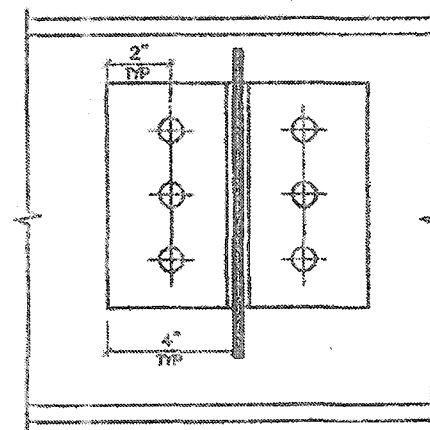


SECTION 1-1

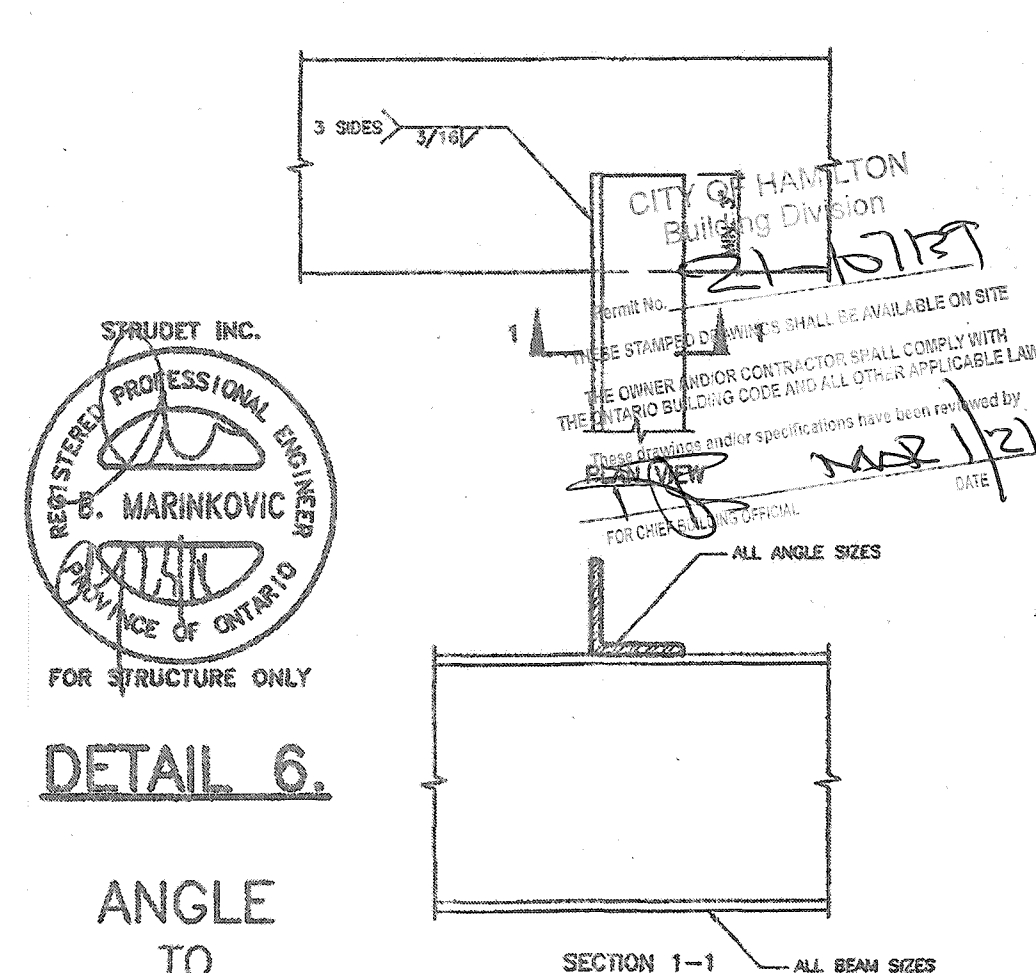


DETAIL 6.


ANGLE
TO
BEAM
CONNECTION

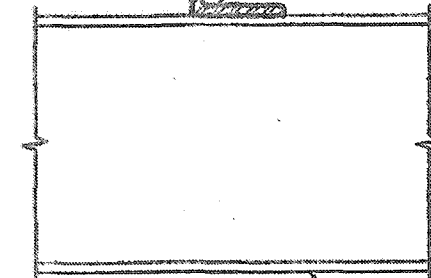

SECTION 1-1 ALL BEAM SIZES

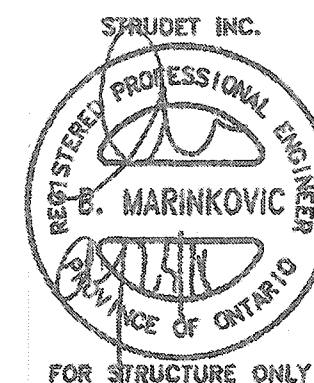


FOR STRUCTURE ONLY

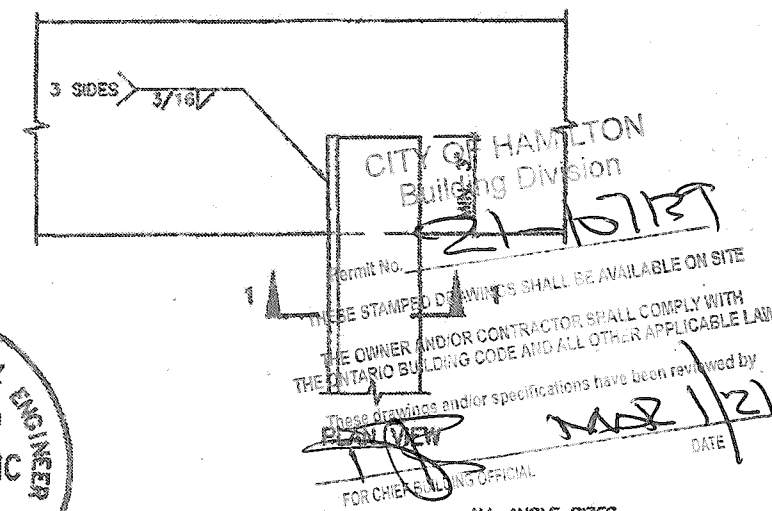


ALL ANGLE SIZES

2012 CODE
COMPLIANCE PACKAGE "A1"


5. _____ 4. _____ 3. _____ 2. _____ 1. ISSUED FOR PERMIT JULY 30, 2018 REVISIONS	The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 3.2.6 of the building code VIKAS GAJJAR 28770 NAME SIGNATURE BCIN	REGION DESIGN INC. 8700 BURNER ST. CONCORD, ONTARIO L4K 4S8 P (416) 736-6095 F (905) 630-0745	SHEET TITLE BEAM DETAILS STEEL SCALE N.T.S. DATE JULY 2018	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED. PAGE No. 10	Greenpark. PROJECT NAME RUSSELL GARDENS III
--	--	---	---	--	---

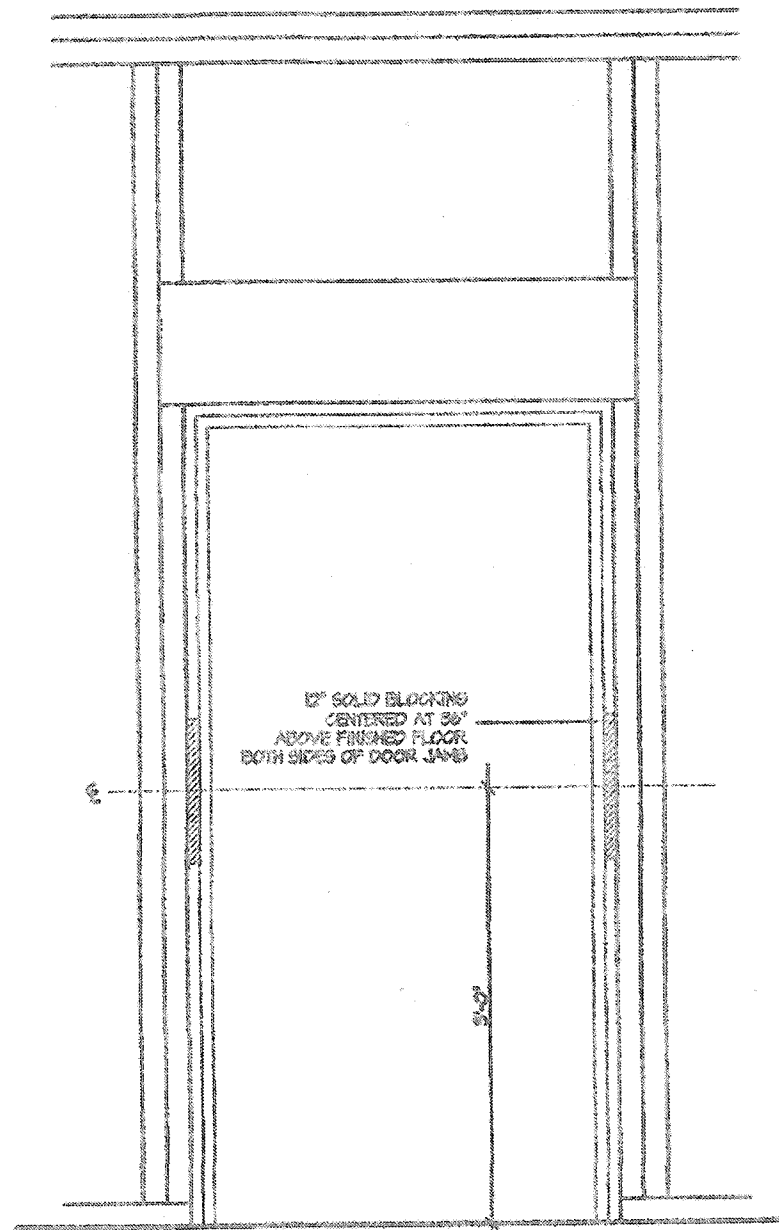


RESISTANCE TO FORCED ENTRY (OBC 9.6.5)

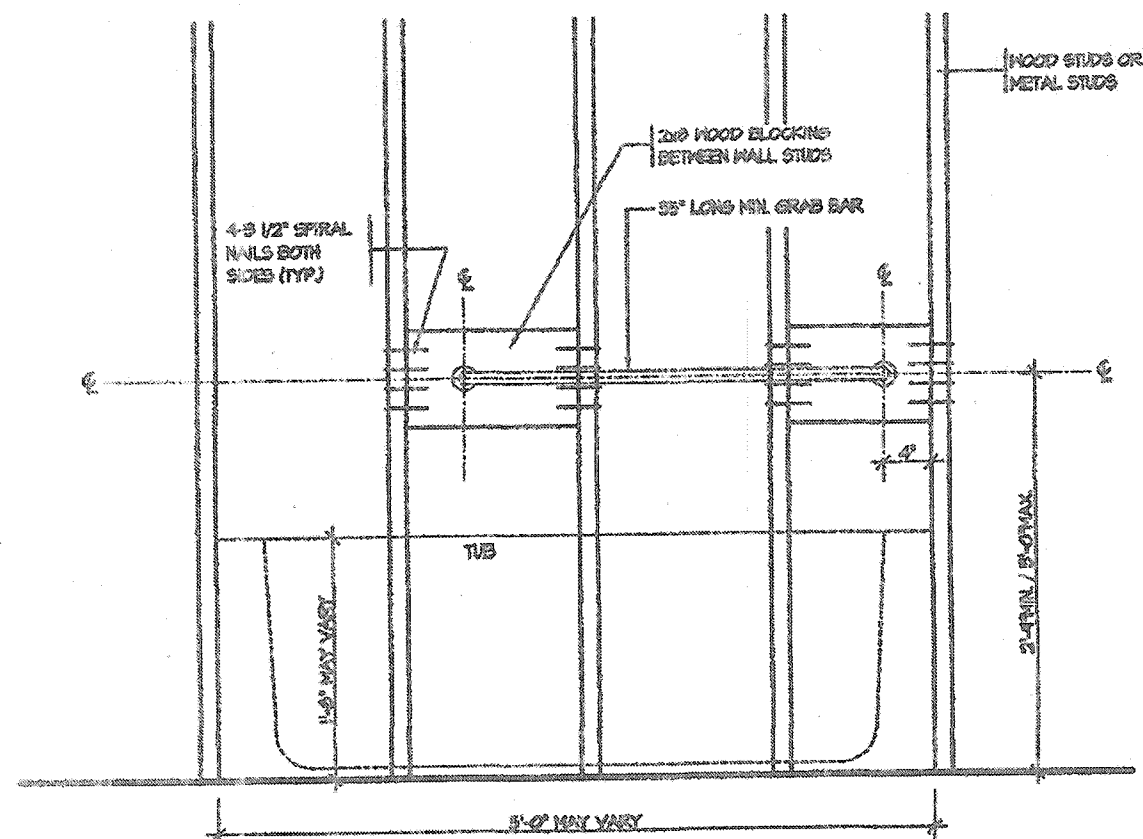

BATH TUB FRONT ELEVATION

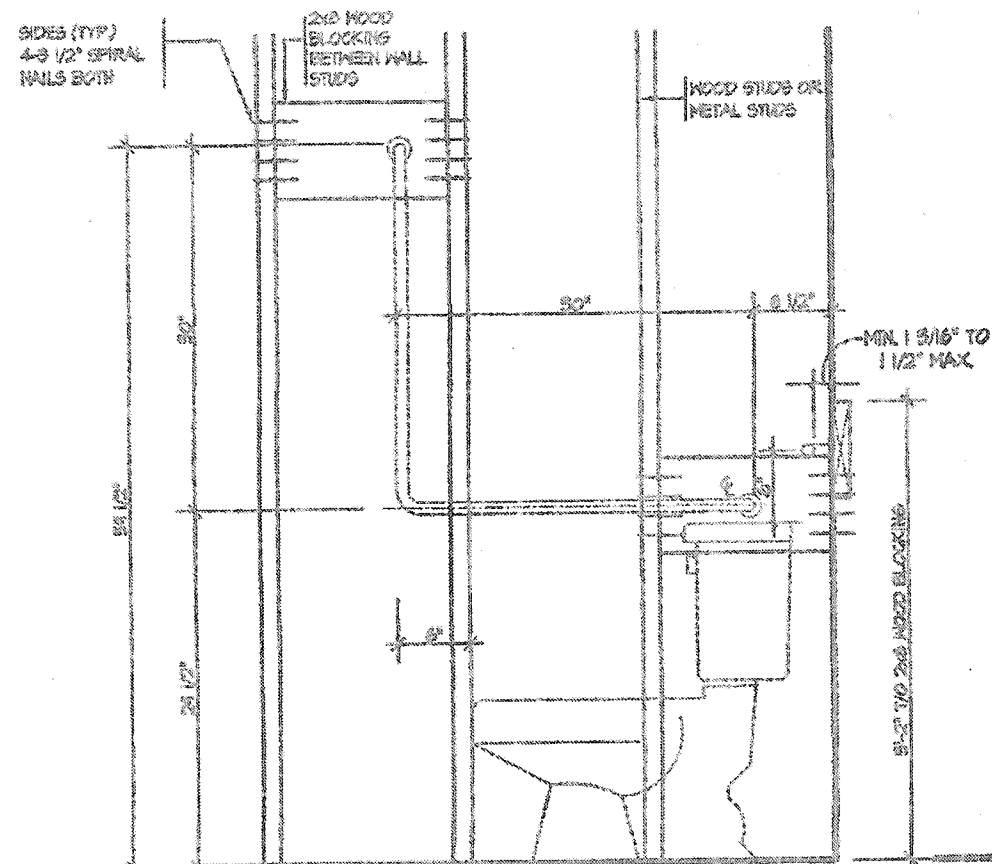

TOILET SIDE ELEVATION

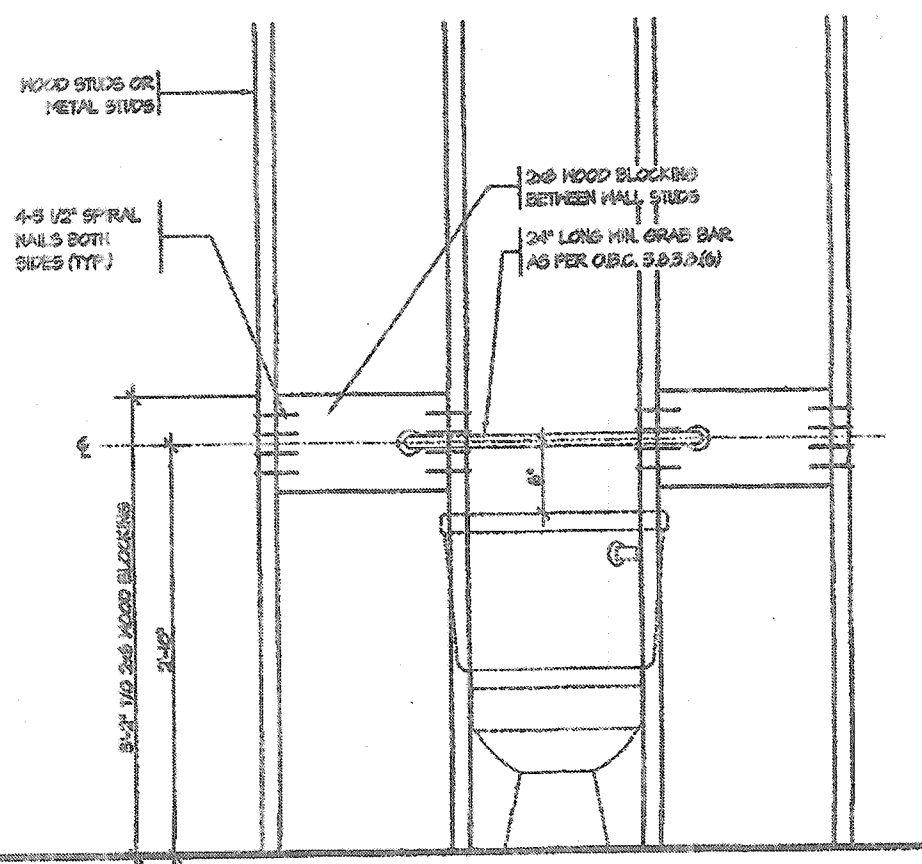

TOILET FRONT ELEVATION

STRUCTURAL REINFORCEMENT FOR GRAB BAR (OBC 9.5.2.3)


CITY OF HAMILTON
Building Division
Permit No. **21-7137**
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
[Signature] **MR 1/21**
FOR CHIEF BUILDING OFFICIAL DATE



FOR STRUCTURE ONLY


**2012 CODE
COMPLIANCE PACKAGE "A1"**

5. 4. 3. 2. 1. ISSUED FOR PERMIT REVISIONS	The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 2.2.5 of the building code VIKAS GAJJAR NAME SIGNATURE 28770 BCIN	REGION DESIGN INC. 9700 DUFFERIN ST. CONCORD, ONTARIO L4K 4S0 P (416) 739-4056 F (905) 660-0746	SHEET TITLE BLOCKING FORCED ENTRY & GRAB BAR SCALE 3/4"=1'-0" DATE JULY 2018	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED. PAGE No. 11	Greenpark. PROJECT NAME RUSSELL GARDENS III
--	---	---	---	--	---

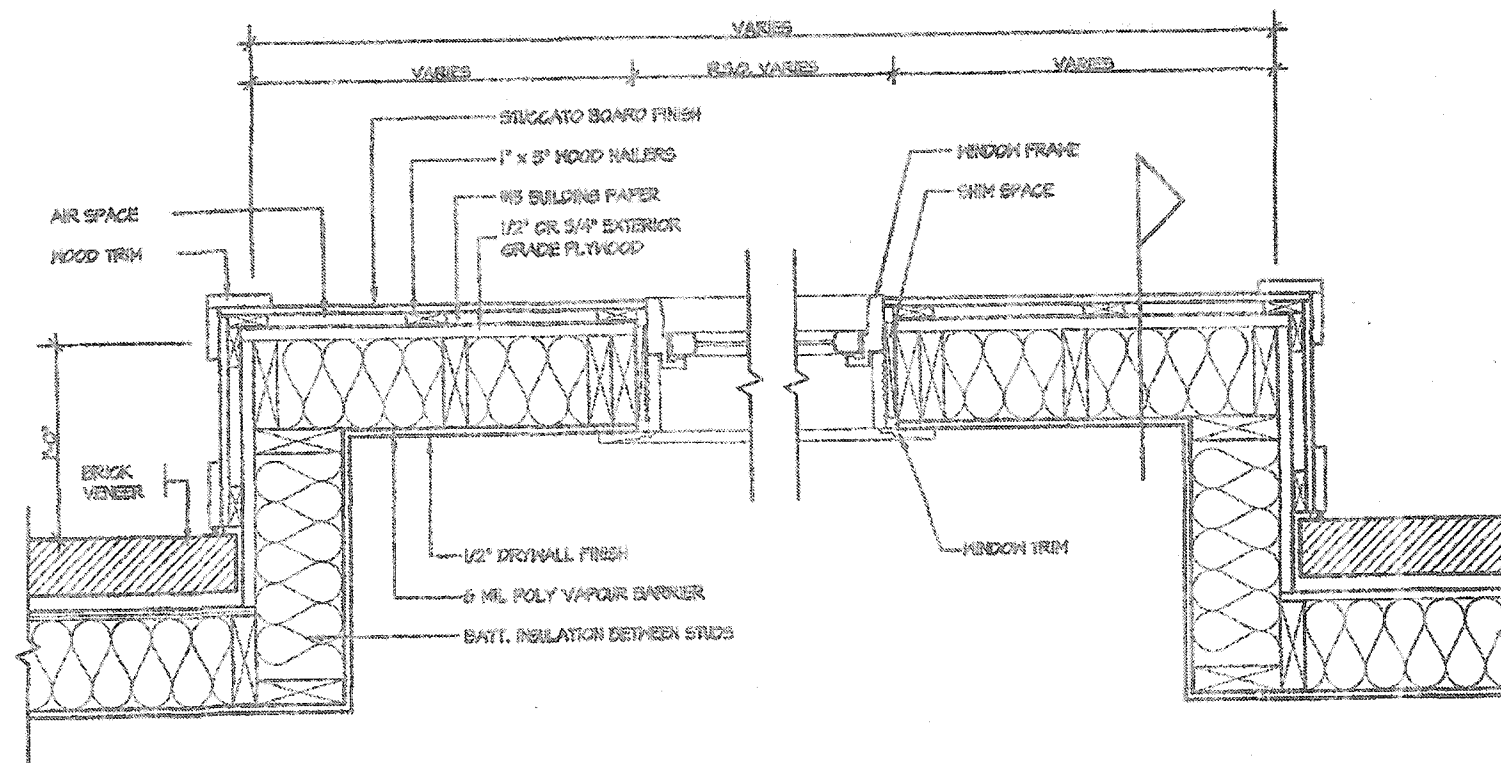


PLAN VIEW

STUCCO BOARD FINISH CLADDING (OBC 9.27)

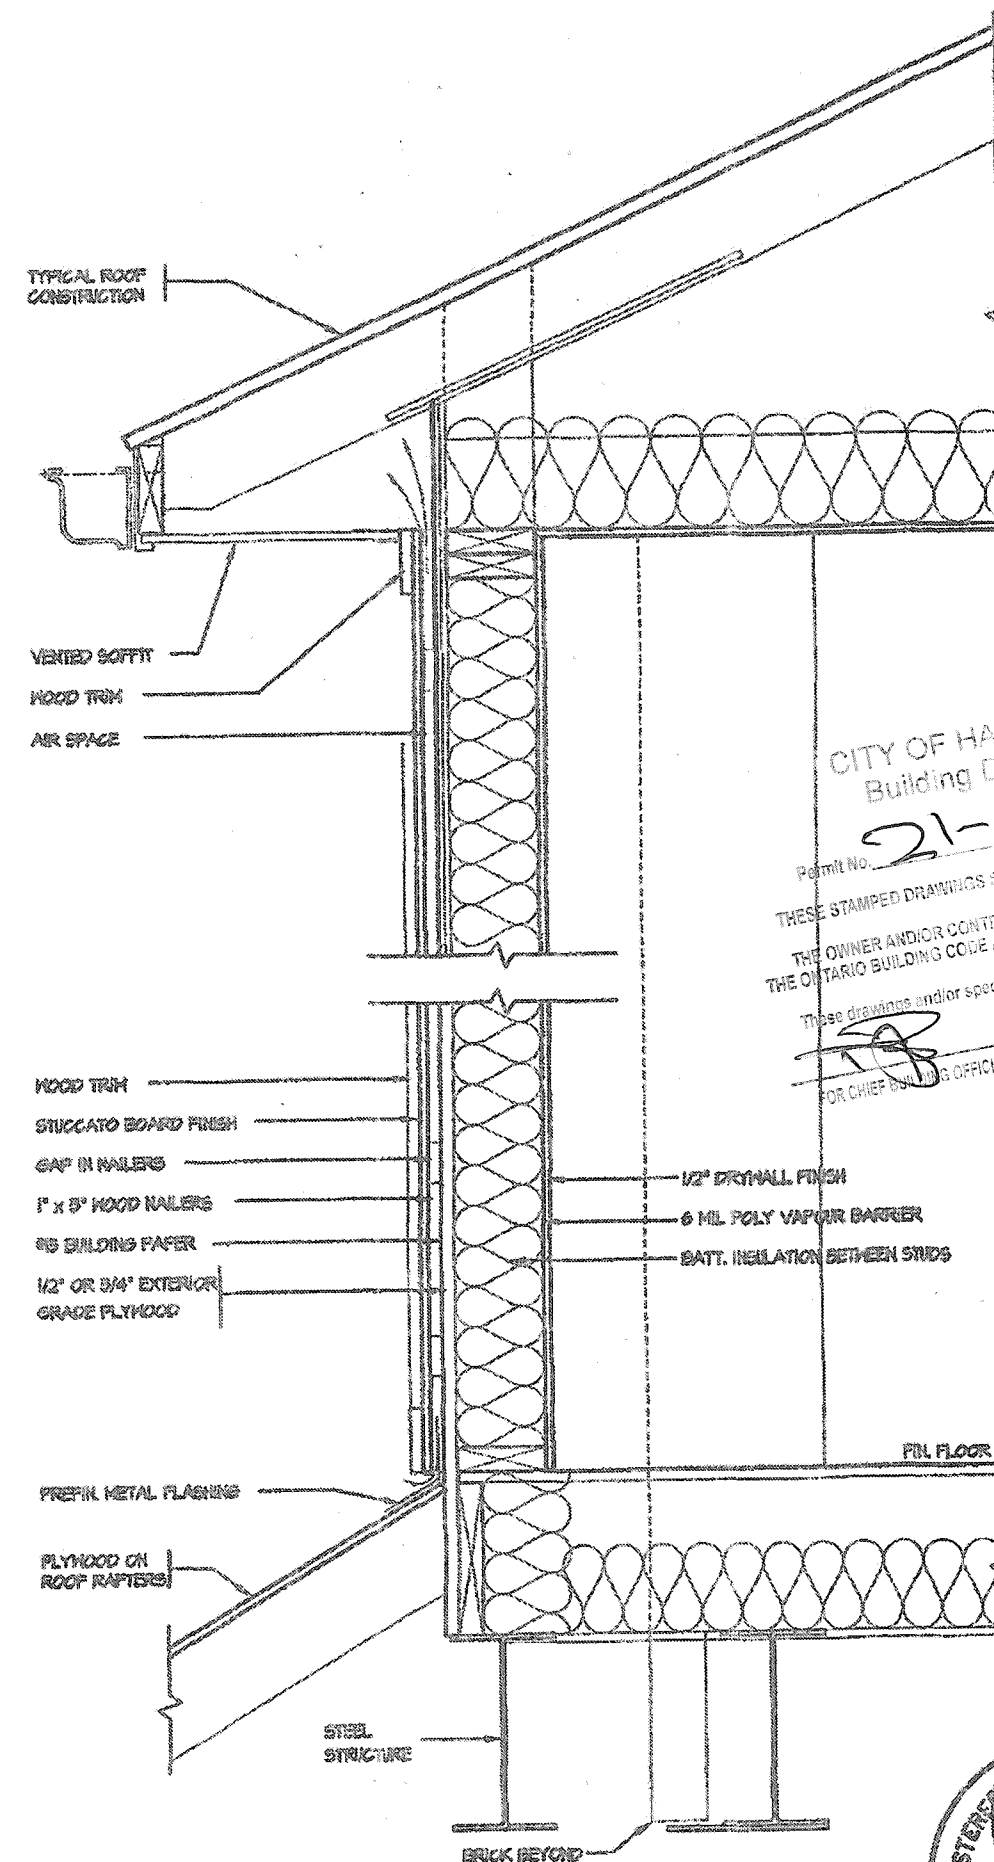

CROSS SECTION

CITY OF HAMILTON
Building Division
Permit No. **21-15713**
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
[Signature] **1/31**
DATE
FOR CHIEF BUILDING OFFICIAL

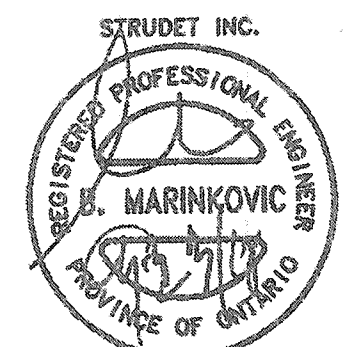


FOR STRUCTURE ONLY


2012 CODE
COMPLIANCE PACKAGE "A1"

5. _____ 4. _____ 3. _____ 2. _____ 1. ISSUED FOR PERMIT JUL 30, 2018		The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 3.2.3 of the Building Code VIKAS GAJJAR 28770 NAME SIGNATURE BCIN		REGION DESIGN INC. 5700 CUFFERIN ST. GAINFORD, ONTARIO L4K 4S6 P (416) 730-4000 F (605) 660-0746		REGION DESIGN INC.		SHEET TITLE STUCCO BOARD FINISH CLADDING SCALE 1/2"=1'-0" DATE JULY 2018		CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED. PAGE NO. 12				PROJECT NAME RUSSELL GARDENS III	
---	--	--	--	---	--	---------------------------	--	--	--	---	--	--	--	--	--

11:06:39 AM H:\STANDARD DETAILS\PERMIT SET\2017\1\1 PACKAGE (MINI) BIP 12 - STUCCO BOARD FINISH PACKAGE A1.DWG JUL 20, 2018

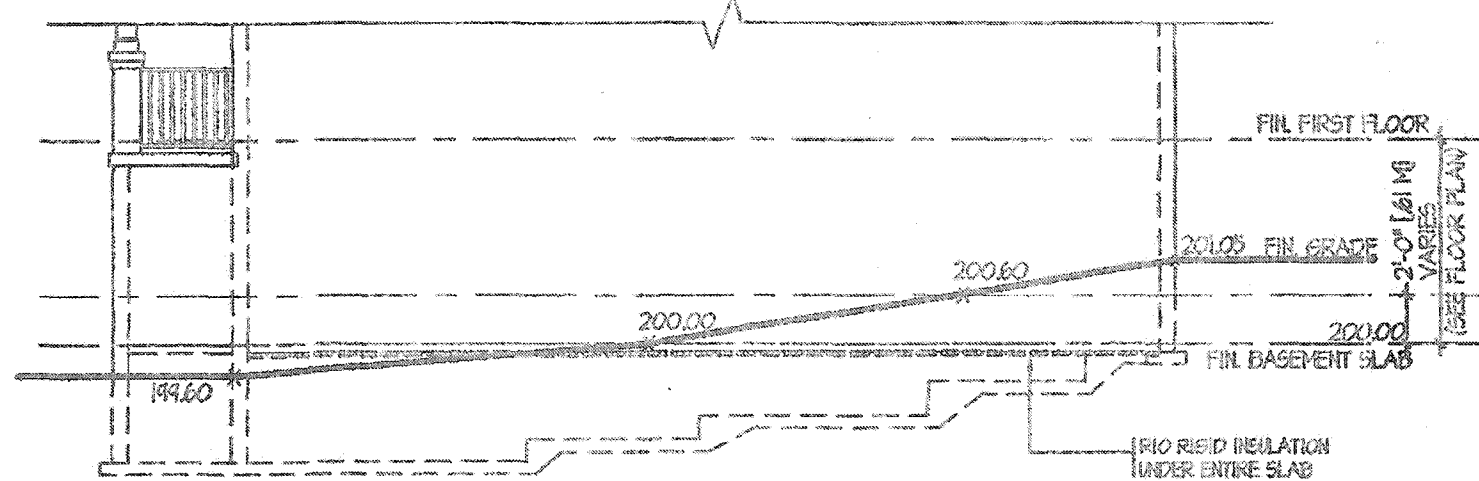


TYPICAL RIGHT SIDE ELEVATION

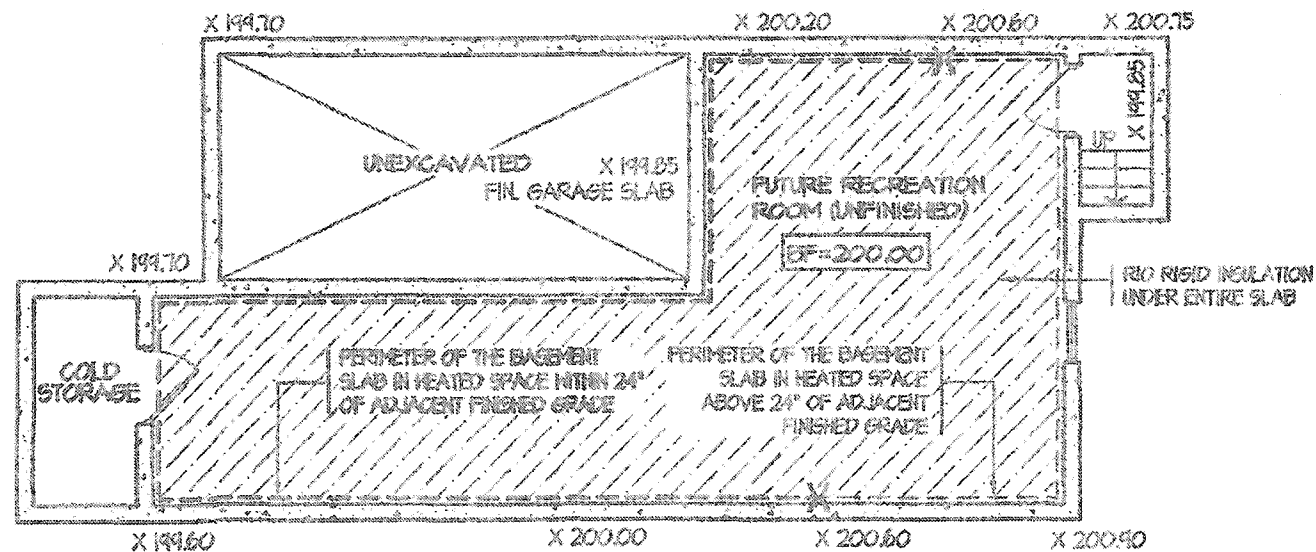


TYPICAL BASEMENT PLAN

SLAB ON GRADE CONDITION

NOTES:
1. LEVELS SHOWN ON THE PLANS ARE FOR ILLUSTRATION PURPOSE ONLY, SEE FINAL GRADING PLAN FOR ACTUAL LEVELS
2. ALL LEVELS ARE SHOWN IN METRIC

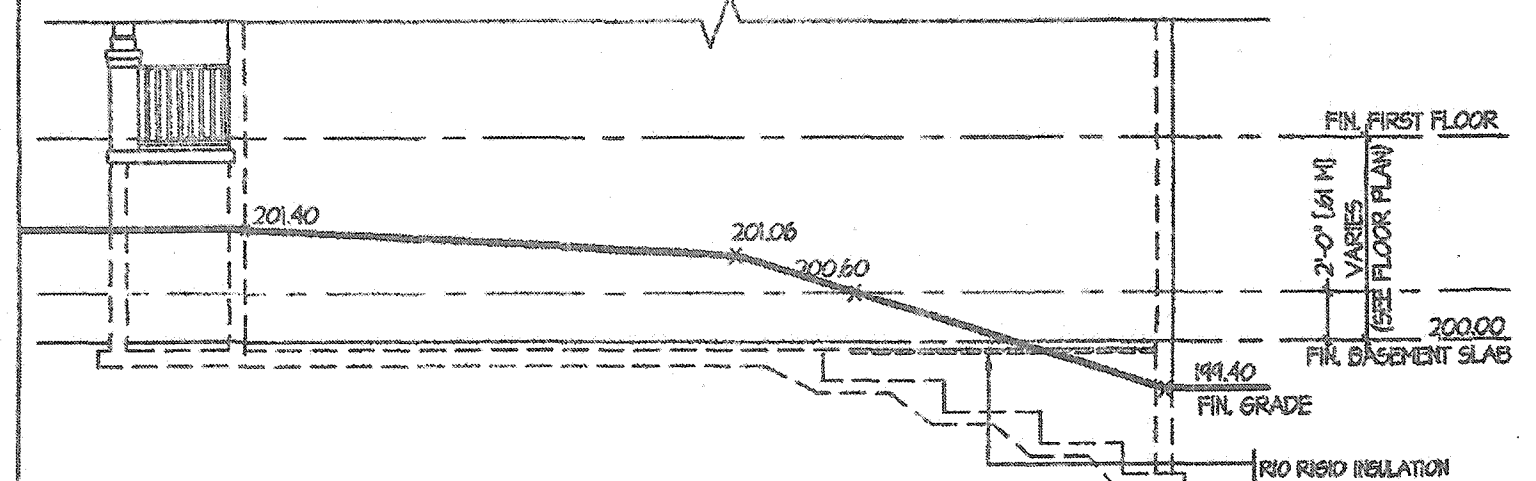


TYPICAL RIGHT SIDE ELEVATION

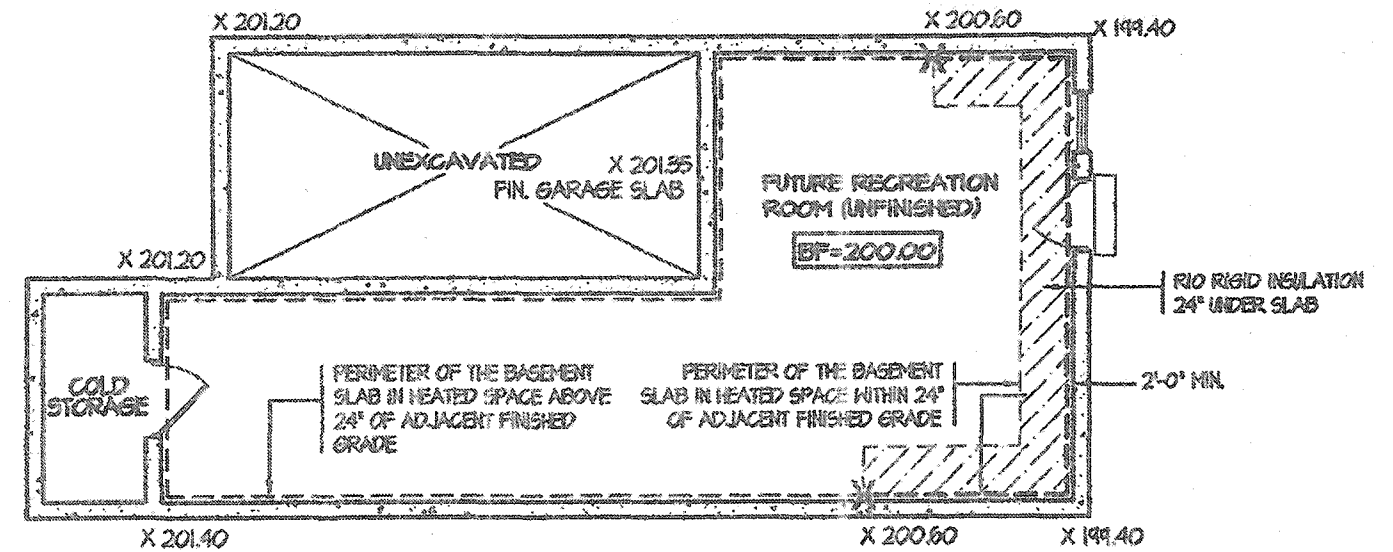

TYPICAL BASEMENT PLAN


WALK OUT BASEMENT CONDITION

NOTES:
1. LEVELS SHOWN ON THE PLANS ARE FOR ILLUSTRATION PURPOSE ONLY, SEE FINAL GRADING PLAN FOR ACTUAL LEVELS
2. ALL LEVELS ARE SHOWN IN METRIC

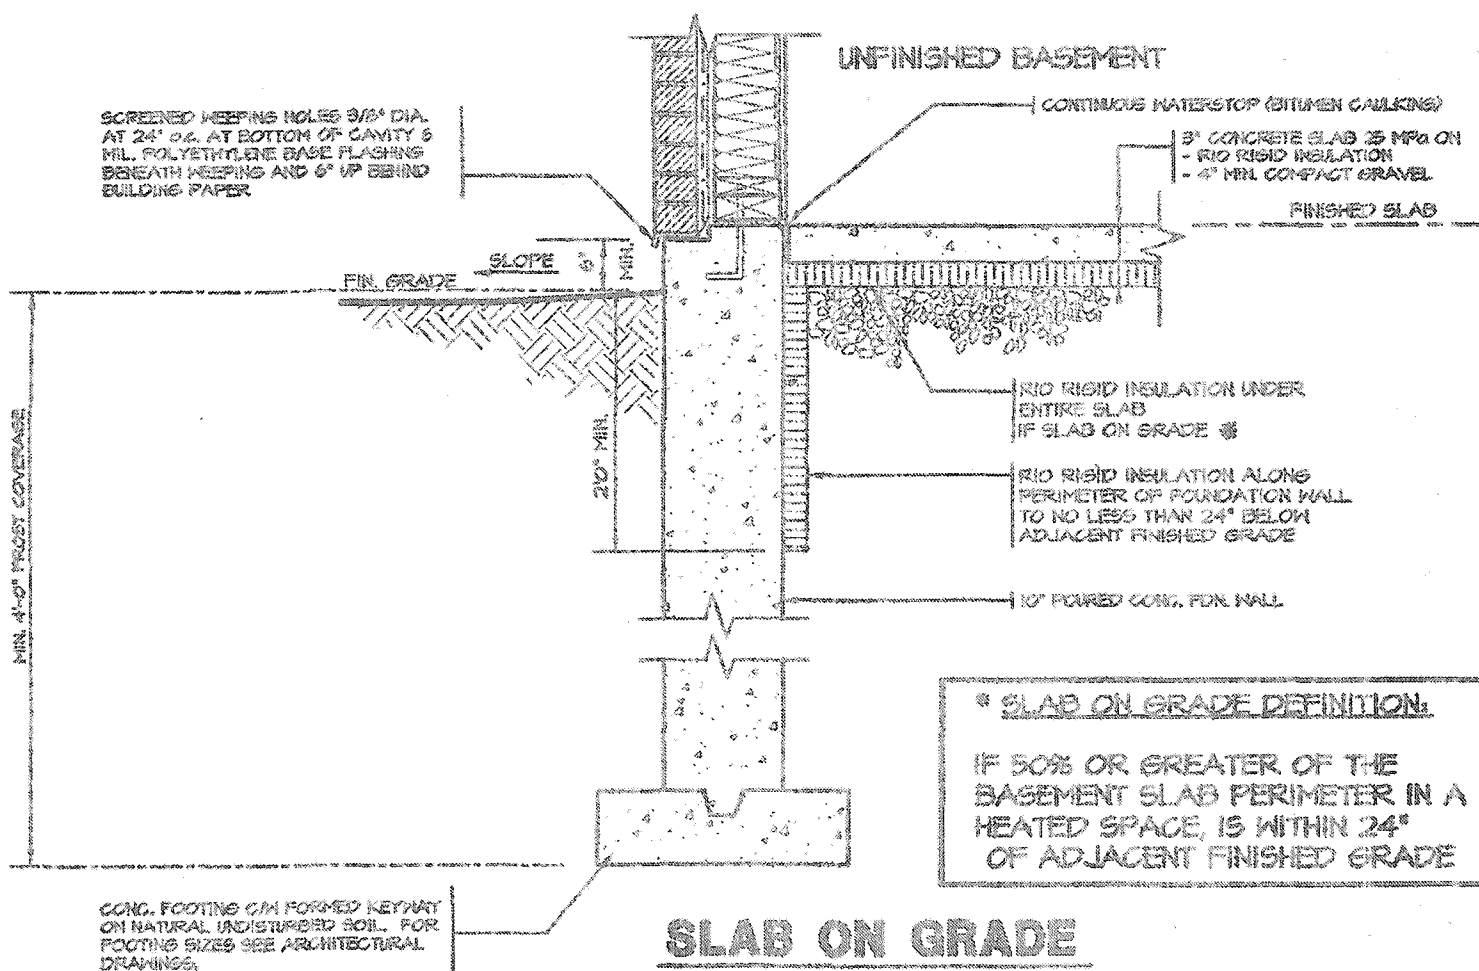

SLAB ON GRADE

* SLAB ON GRADE DEFINITION:
IF 50% OR GREATER OF THE BASEMENT SLAB PERIMETER IN A HEATED SPACE IS WITHIN 24" OF ADJACENT FINISHED GRADE

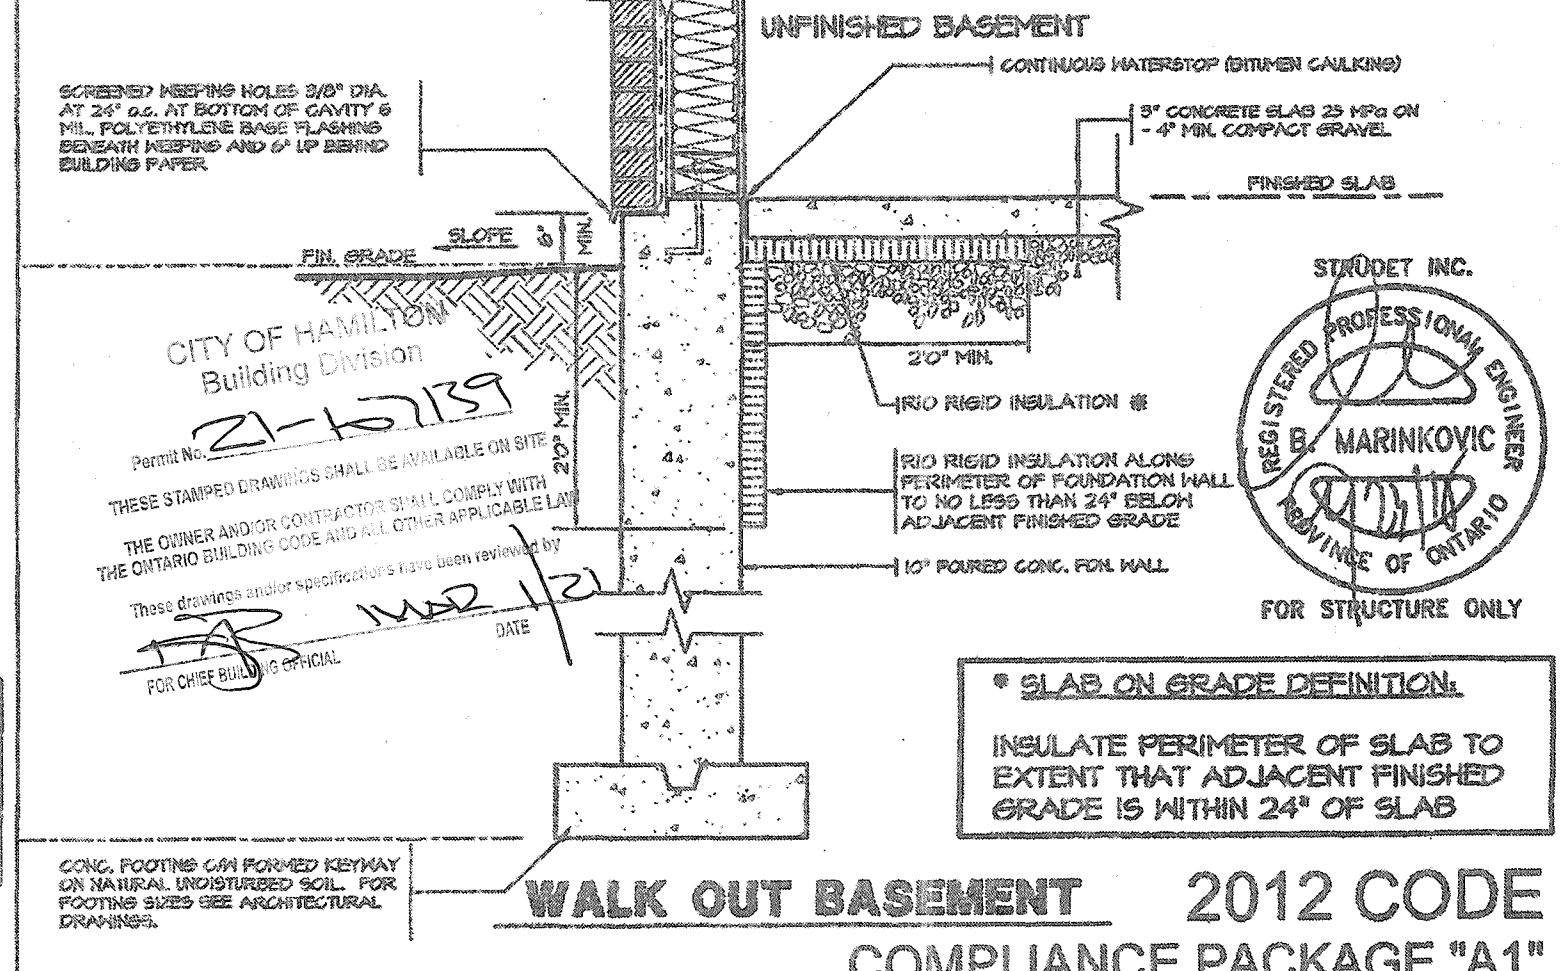

WALK OUT BASEMENT 2012 CODE COMPLIANCE PACKAGE "A1"

* SLAB ON GRADE DEFINITION:
INSULATE PERIMETER OF SLAB TO EXTENT THAT ADJACENT FINISHED GRADE IS WITHIN 24" OF SLAB

NO.	REVISIONS	DATE
1	ISSUED FOR PERMIT	JUL 30, 2018

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION
Required unless design is exempt under Division C, Subsection 3.2.5 of the building code

VIKAS GAJJAR
NAME
SIGNATURE
28770
BCIN

REGION DESIGN INC.
5700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S5
P (416) 735-4000
F (905) 500-0743

REGION DESIGN INC.

SHEET TITLE
SLAB ON GRADE WALKOUT BASEMENT
SCALE
N.T.S.
DATE
JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.

PAGE No.
13


PROJECT NAME
RUSSELL GARDENS III

Greenpark



NOTE: FOR MORE THAN 8 RISERS

- CITY OF HAMILTON
Building Division
- Permit No. 21-107189
- THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
- These drawings and specifications have been reviewed by
[Signature] M.R. [Signature]
DATE 12/1
- FOR CHIEF BUILDING OFFICIAL

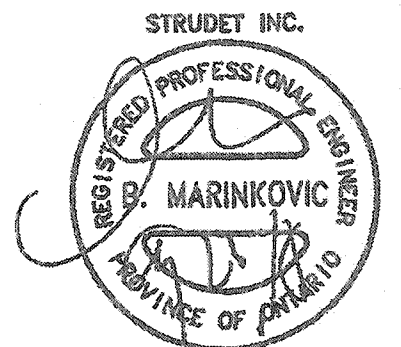

FOR STRUCTURE ONLY
2012 CODE
COMPLIANCE PACKAGE "A1"

5.			The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 3.2.6 of the Building Code VIKAS GAJJAR  28770 NAME SIGNATURE BCIN	REGION DESIGN INC. 8700 DUFFERIN ST. CONCORD, ONTARIO P (416) 736-4088 F (905) 660-0746		SHEET TITLE POURED CONCRETE STAIRS	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.		
4.						SCALE 3/8"=1'-0"	FACE NO. 14		PROJECT NAME RUSSELL GARDENS III
3.						DATE JULY 2018			
2.									
1.	ISSUED FOR PERMIT	JUL 30, 2018							
REVISIONS									