


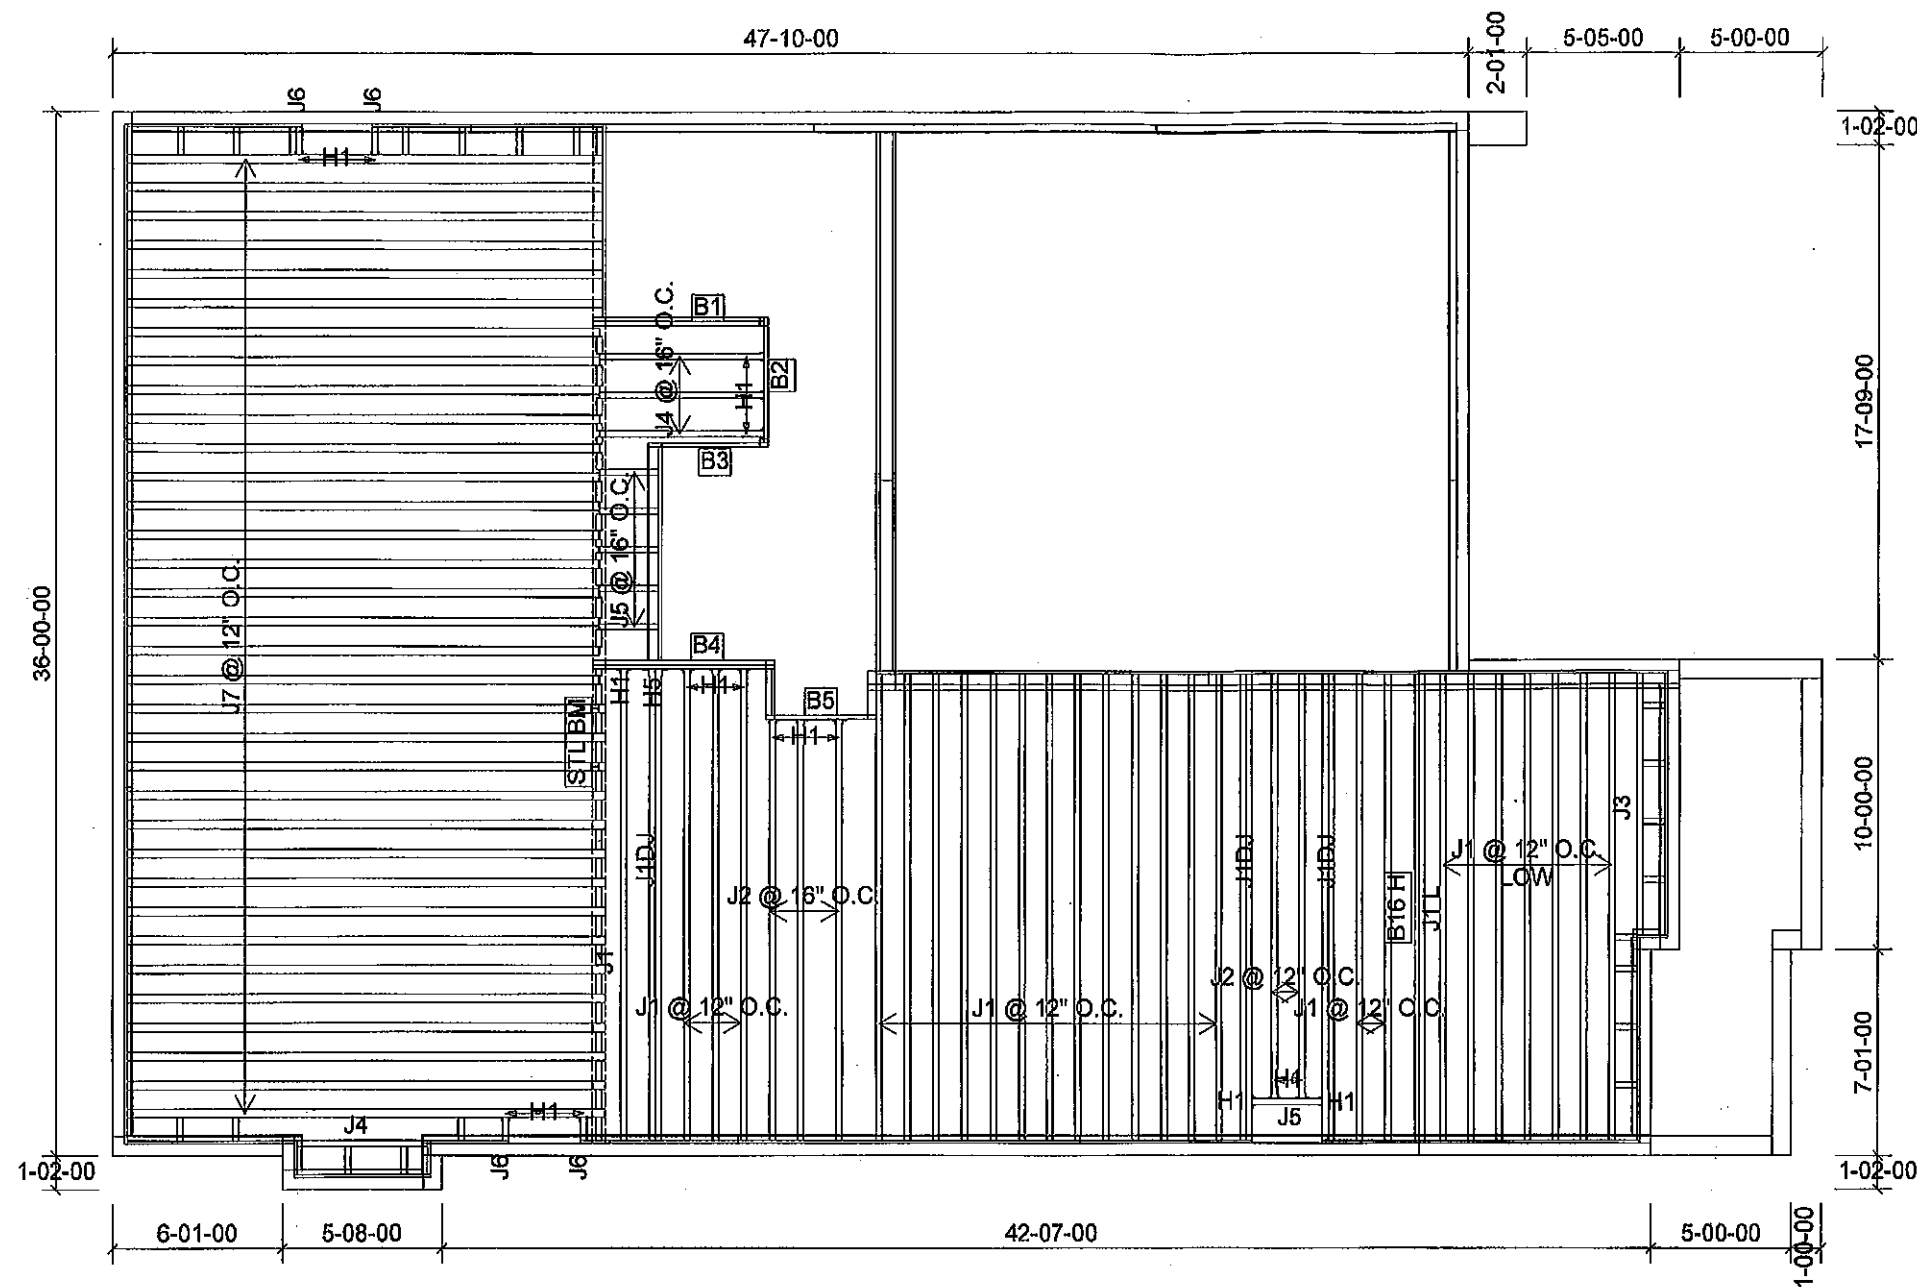

| Products |          |                                        |       |         |          |
|----------|----------|----------------------------------------|-------|---------|----------|
| PlotID   | Length   | Product                                | Plies | Net Qty | Fab Type |
| J1       | 18-00-00 | 9 1/2" NI-40x                          | 1     | 26      | MFD      |
| J1 L     | 18-00-00 | 9 1/2" NI-40x                          | 1     | 1       | MFD      |
| J1DJ     | 18-00-00 | 9 1/2" NI-40x                          | 2     | 6       | MFD      |
| J2       | 16-00-00 | 9 1/2" NI-40x                          | 1     | 5       | MFD      |
| J3       | 10-00-00 | 9 1/2" NI-40x                          | 1     | 1       | MFD      |
| J4       | 6-00-00  | 9 1/2" NI-40x                          | 1     | 4       | MFD      |
| J5       | 4-00-00  | 9 1/2" NI-40x                          | 1     | 6       | MFD      |
| J6       | 2-00-00  | 9 1/2" NI-40x                          | 1     | 4       | MFD      |
| J7       | 18-00-00 | 9 1/2" NI-80                           | 1     | 34      | MFD      |
| B16 H    | 18-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       | MFD      |
| B4       | 8-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       | MFD      |
| B2       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       | MFD      |
| B3       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       | MFD      |
| B1       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       | MFD      |
| B5       | 4-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       | MFD      |

| Connector Summary |       |             |
|-------------------|-------|-------------|
| Qty               | Manuf | Product     |
| 6                 | H1    | IUS2.56/9.5 |
| 4                 | H1    | IUS2.56/9.5 |
| 2                 | H1    | IUS2.56/9.5 |
| 2                 | H1    | IUS2.56/9.5 |
| 4                 | H1    | IUS2.56/9.5 |
| 1                 | H5    | HU312-2     |

TAMARACK

LUMBER INC

ALPHA LUMBER GROUP

FROM PLAN DATED: AUG 28, 2020

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS PH 3

MODEL: MOUNTAINASH 5

ELEVATION: 3

LOT: 314

CITY: WATERDOWN

SALESMAN: MARIO DICIANO

DESIGNER: AJ

REVISION: L.D.

NOTES:

REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION.

SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. MULTIPLE SQUASH BLOCKS REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. CANTILEVERED JOISTS INCLUDING CANT' OVER BRICK REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR HOLES INCLUDING DUCT CHASE AND FIELD CUT OPENINGS SEE FIGURE 7, TABLES 1 & 2. CERAMIC TILE APPLICATION AS PER O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000


LIVE LOAD: 40.0 lb/ft²

DEAD LOAD: 20.0 lb/ft²

SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 2020-09-16

1st FLOOR



FROM PLAN DATED: AUG 28, 2020

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS PH 3

MODEL: MOUNTAINASH 5

ELEVATION: 3

LOT: 314

CITY: WATERDOWN

SALESMAN: MARIO DICIANO

DESIGNER: AJ

REVISION: L.D.

NOTES:  
REFER TO THE NORDIC **INSTALLATION GUIDE** FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

LOADING:

DESIGN LOADS: L/480.000


LIVE LOAD: 40.0 lb/ft²

DEAD LOAD: 20.0 lb/ft ²

SUBFLOOR: 5/8" GLUED AND NAILED


DATE: 2020-09-16

2nd FLOOR

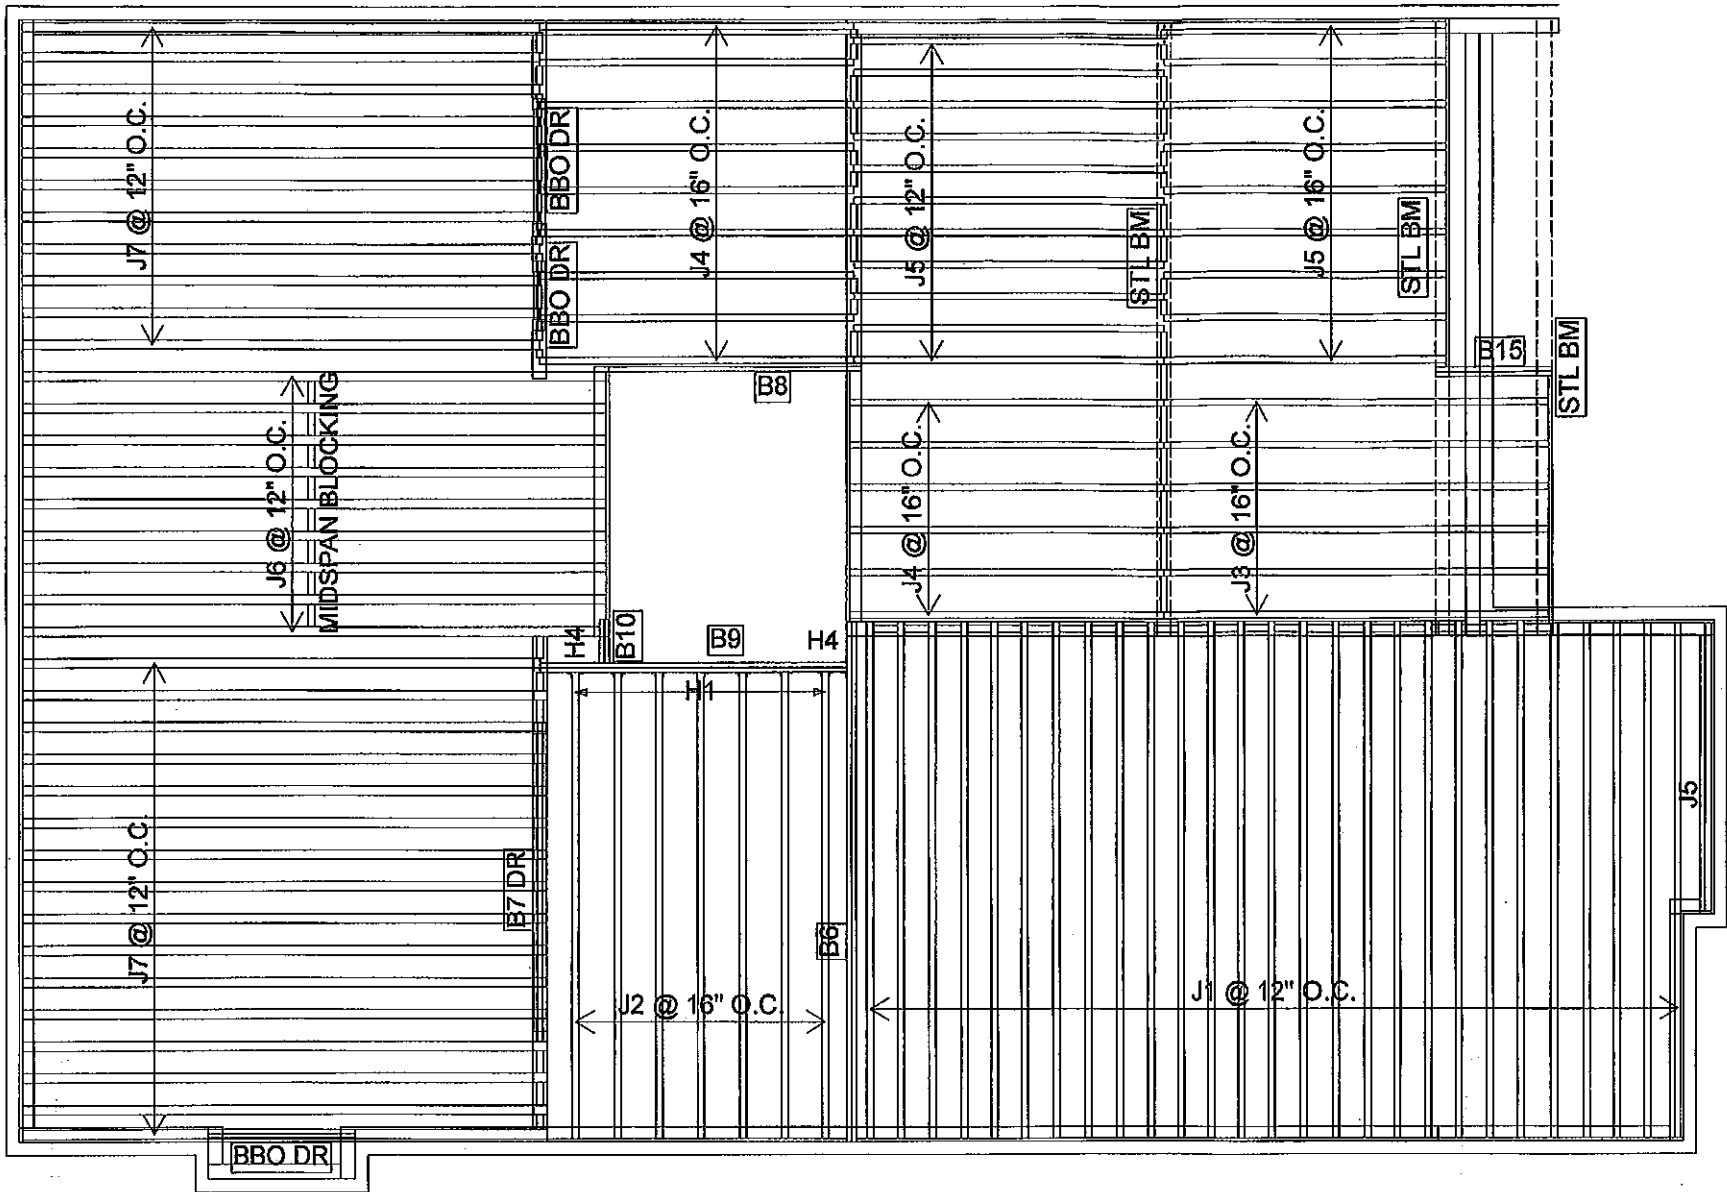

| Products |          |                                        |       |         |          |
|----------|----------|----------------------------------------|-------|---------|----------|
| PlotID   | Length   | Product                                | Plies | Net Qty | Fab Type |
| J1       | 18-00-00 | 9 1/2" NI-40x                          | 1     | 27      | MFD      |
| J2       | 16-00-00 | 9 1/2" NI-40x                          | 1     | 7       | MFD      |
| J3       | 14-00-00 | 9 1/2" NI-40x                          | 1     | 6       | MFD      |
| J4       | 12-00-00 | 9 1/2" NI-40x                          | 1     | 15      | MFD      |
| J5       | 10-00-00 | 9 1/2" NI-40x                          | 1     | 21      | MFD      |
| J6       | 20-00-00 | 9 1/2" NI-80                           | 1     | 9       | MFD      |
| J7       | 18-00-00 | 9 1/2" NI-80                           | 1     | 27      | MFD      |
| B6       | 18-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       | MFD      |
| B8       | 10-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       | MFD      |
| B9       | 10-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       | MFD      |
| B7 DR    | 10-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 3     | 3       | MFD      |
| B15      | 4-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       | MFD      |
| B10      | 2-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       | MFD      |

| Connector Summary |       |             |
|-------------------|-------|-------------|
| Qty               | Manuf | Product     |
| 7                 | H1    | IUS2.56/9.5 |
| 2                 | H4    | HGUS410     |

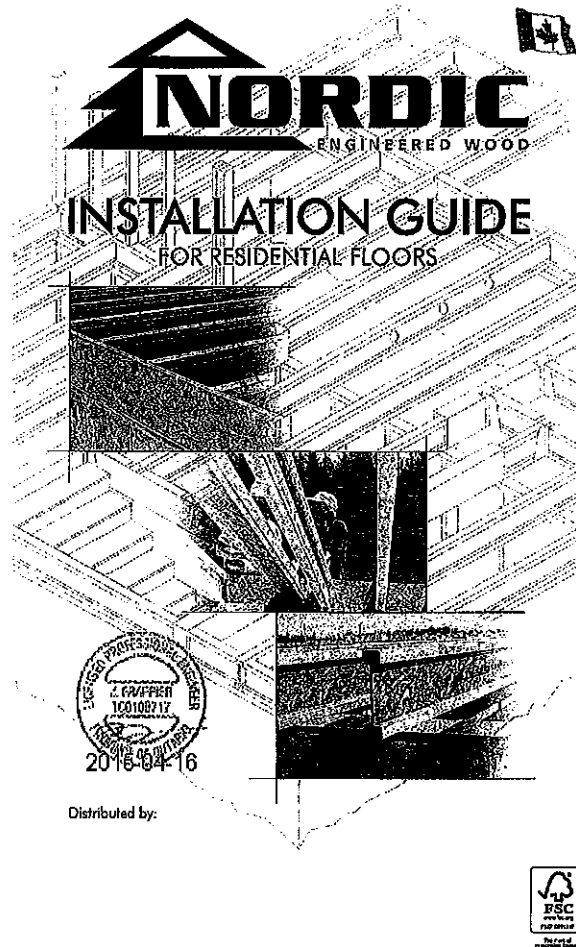

### SAFETY AND CONSTRUCTION PRECAUTIONS

**WARNING**  
I-joists are not stable until completely installed, and will not carry any load until fully braced and sheathed.

**Do not walk on I-joists until fully fastened and braced, or serious injuries can result.**

**Never stack building materials over unbraced I-joists. Once sheathed, do not over-stress I-joist with concentrated loads from building materials.**

**Improper storage or installation, failure to follow applicable building codes, failure to follow span ratings for Nordic I-joists, failure to follow allowable hole sizes and locations, or failure to use web stiffeners when required can result in serious accidents. Follow these installation guidelines carefully.**

**WARNING**  
I-joists are not stable until completely installed, and will not carry any load until fully braced and sheathed.

**Avoid Accidents by Following these Important Guidelines:**

1. Brace and nail each I-joist as it is installed, using hangers, blocking panels, rim board, and/or cross-briding at joint ends. When I-joists are applied continuous over interior supports and a load-bearing wall is planned at that location, blocking will be required of the interior support.
2. When the building is completed, the floor sheathing will provide lateral support for the top flanges of the I-joists. Until this sheathing is applied, temporary bracing, often called struts, or temporary sheathing must be applied to prevent I-joist rollover or buckling.
  - Temporary bracing or struts must be 1x4 inch minimum, at least 8 feet long and spaced no more than 8 feet on center, and must be secured with a minimum of two 2-1/2" nails fastened to the top surface of each I-joist. Nail the bracing to a lateral resistant at the end of each bay. Lap ends of adjoining bracing over at least two I-joists.
  - Or sheathing (temporary or permanent) can be nailed to the top flange of the first 4 feet of I-joists at the end of the bay.
3. For cantilevered I-joists, brace top and bottom flanges, and brace ends with cleave panels, rim board, or cross-bridging.
4. Install and fully nail permanent sheathing to each I-joist before placing loads on the floor system. Then, stack building materials over beams or walls only.
5. Never install a damaged I-joist.

### STORAGE AND HANDLING GUIDELINES

1. Bundle wrap can be slippery when wet. Avoid walking on wrapped bundles.
2. Store, stack, and handle I-joists vertically and level only.
3. Always stack and handle I-joists in the upright position only.
4. Do not store I-joists in direct contact with the ground and/or rotative.
5. Protect I-joists from weather, and use spacers to separate bundles.
6. Bundled units should be kept intact until time of installation.
7. When handling I-joists with a crane on the job site, take a few simple precautions to prevent damage to the I-joists and injury to your work crew.
  - Pick I-joists in bundles as shipped by the supplier.
  - Orient the bundles so that the webs of the I-joists are vertical.
  - Pick the bundles at the 5th points, using a spreader bar if necessary.
8. Do not handle I-joists in a horizontal orientation.
9. NEVER USE OR TRY TO REPAIR A DAMAGED I-JOIST.

### MAXIMUM FLOOR SPANS

1. Maximum clear spans applicable to single-span or multiple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.5L + 1.25D. The serviceability limit states include the consideration for floor vibration and a live load deflection limit of 1/480. For multiple-span applications, the end spans shall be 40% or more of the adjacent span.

2. Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less, or 3/4 inch for joist spacing of 24 inches. Adhesives shall meet the requirements given in CGS-71.26 Standard. No concrete topping or bridging element was assumed. Increased spans may be achieved with the use of gypsum and/or a row of blocking at mid-span.

3. Minimum bearing length shall be 1-3/4 inches for the end bearings, and 3-1/2 inches for the intermediate bearings.

4. Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.

5. The span chart is based on uniform loads. For applications with other than uniform loads, an engineering analysis may be required based on the use of the design properties.

6. Tables are based on United States Design per CAN/CSA O86-09 Standard, and NSC 2010.

7. SI units conversion: 1 inch = 25.4 mm, 1 foot = 0.305 m

### MAXIMUM FLOOR SPANS FOR NORDIC I-JOISTS SINGLE AND MULTIPLE SPANS

| Joist Depth | Joist Series | Single spans      |       |       |        | Multiple spans    |       |        |       |
|-------------|--------------|-------------------|-------|-------|--------|-------------------|-------|--------|-------|
|             |              | On center spacing | 12"   | 16"   | 19.2"  | On center spacing | 12"   | 16"    | 19.2" |
| 9-1/2"      | N1-20        | 13'1"             | 14'2" | 13'9" | 13'5"  | 16'2"             | 15'4" | 14'10" | 14'7" |
|             | N1-40        | 14'0"             | 15'1" | 14'8" | 14'4"  | 17'5"             | 16'7" | 15'10" | 15'6" |
|             | N1-60        | 14'6"             | 15'7" | 15'4" | 14'10" | 17'7"             | 16'7" | 15'10" | 15'6" |
| 11-7/8"     | N1-20        | 16'1"             | 17'2" | 16'9" | 16'5"  | 18'10"            | 17'4" | 16'11" | 16'7" |
|             | N1-40        | 16'1"             | 17'2" | 16'9" | 16'5"  | 18'10"            | 17'4" | 16'11" | 16'7" |
|             | N1-60        | 16'1"             | 17'2" | 16'9" | 16'5"  | 18'10"            | 17'4" | 16'11" | 16'7" |
| 14"         | N1-20        | 18'1"             | 19'2" | 18'9" | 18'5"  | 20'10"            | 19'4" | 18'11" | 18'7" |
|             | N1-40        | 18'1"             | 19'2" | 18'9" | 18'5"  | 20'10"            | 19'4" | 18'11" | 18'7" |
|             | N1-60        | 18'1"             | 19'2" | 18'9" | 18'5"  | 20'10"            | 19'4" | 18'11" | 18'7" |
| 16"         | N1-20        | 20'1"             | 21'2" | 20'9" | 20'5"  | 22'10"            | 21'4" | 21'1"  | 20'7" |
|             | N1-40        | 20'1"             | 21'2" | 20'9" | 20'5"  | 22'10"            | 21'4" | 21'1"  | 20'7" |
|             | N1-60        | 20'1"             | 21'2" | 20'9" | 20'5"  | 22'10"            | 21'4" | 21'1"  | 20'7" |

### I-JOIST HANGERS

1. Hangers shown illustrate the three most commonly used metal hangers to support I-joists.
2. All nailing must meet the hanger manufacturer's recommendations.
3. Hangers should be selected based on the joist depth, flange width and load capacity based on the maximum spans.
4. Web stiffeners are required when the sides of the hangers do not laterally brace the top flange of the I-joist.

Top Mount  
Stacked  
Face Mount

### WEB STIFFENERS

**RECOMMENDATIONS:**

• A bearing stiffener is required in all engineered applications with fastened reactions greater than shown in the Joist properties table found in the I-joist Construction Guide (C101). The gap between the stiffener and the flange is at the top.

• A bearing stiffener is required when the I-joist is supported in a hanger and the sides of the hanger do not extend up to, and support, the top flange. The gap between the stiffener and flange is at the top.

• A load stiffener is required at locations where a factored concentrated load greater than 2,370 lbs is applied to the top flange between supports, or in the case of a cantilever, anywhere between the cantilever tip and the support. These values are for standard term load duration, and may be adjusted for other load durations as permitted by the code. The gap between the stiffener and the flange is at the bottom.

SI units conversion: 1 inch = 25.4 mm

**FIGURE 2 WEB STIFFENER INSTALLATION DETAILS**

**STIFFENER SIZE REQUIREMENTS**

| Flange Width | Web Stiffener Size Each Side of Web |
|--------------|-------------------------------------|
| 2-1/2"       | 1" x 2-5/16" minimum width          |
| 3-1/2"       | 1-1/2" x 2-5/16" minimum width      |

### NORDIC I-JOIST SERIES

2015-04-16

### INSTALLING NORDIC I-JOISTS

1. Before laying out floor system components, verify that I-joist flange widths match hanger widths. If not, contact your supplier.
2. Except for cutting to length, I-joist flanges should never be cut, drilled, or notched.
3. Install I-joists so that top and bottom flanges are within 1/2 inch of true vertical alignment.
4. I-joists must be anchored securely to supports before floor sheathing is attached, and supports must be braced to prevent movement.
5. Minimum bearing lengths: 1-3/4 inches for end bearings and 3-1/2 inches for intermediate bearings.
6. When using hangers, seat I-joists firmly in hanger bottoms to minimize settlement.
7. Leave a 1/16-inch gap between the I-joist and a header.
8. Concentrated loads greater than those that can normally be expected in residential construction should only be applied to the top surface of the top flange. Normal concentrated loads include track lighting fixtures, audio equipment and security cameras. Never suspend unusual or heavy loads from the I-joist's bottom flange. Whenever possible, suspend all concentrated loads from the top of the I-joist. Or, attach the load to blocking that has been securely fastened to the I-joist webs.
9. Never install I-joists where they will be permanently exposed to weather, or where they will remain in direct contact with concrete or masonry.
10. Restrain ends of floor joists to prevent rollover. Use rim board, rim joists or I-joist blocking panels.
11. For I-joists installed over and beneath bearing walls, use full depth blocking panels, rim board, or squash blocks (apple members) to transfer gravity loads through the floor system to the wall or foundation below.
12. Due to shrinkage, common framing lumber set on edge may never be used as blocking or rim boards. I-joist blocking panels or other engineered wood products - such as rim board - must be cut to fit between the I-joists, and an I-joist-compatible depth selected.
13. Provide permanent lateral support of the bottom flange of all I-joists at interior supports of multiple-span joists. Similarly, support the bottom flange of all cantilevered I-joists at the end support next to the cantilever extension. In the completed structure, the gypsum wallboard ceiling provides this lateral support. Until the final finished ceiling is applied, temporary bracing or struts must be used.
14. If square-edge panels are used, edges must be supported between I-joists with 2x4 blocking. Or use panels to blocking to minimize squeaks. Blocking is not required under structural finish flooring, such as wood strip flooring, or if a separate underlayment layer is installed.
15. Nail spacing: Space nails installed to the flange's top face in accordance with the applicable building code requirements or approved building plans.

**FIGURE 1 TYPICAL NORDIC I-JOIST FLOOR FRAMING AND CONSTRUCTION DETAILS**

2015-04-16

**FIGURE 1 TYPICAL NORDIC I-JOIST FLOOR FRAMING AND CONSTRUCTION DETAILS**

2015-04-16

**FIGURE 1 TYPICAL NORDIC I-JOIST FLOOR FRAMING AND CONSTRUCTION DETAILS**

2015-04-16

**FIGURE 1 TYPICAL NORDIC I-JOIST FLOOR FRAMING AND CONSTRUCTION DETAILS**

2015-04-16







# NORDIC STRUCTURES

**COMPANY**  
Aug. 20, 2020 09:25


**PROJECT**  
J7 1ST FLOOR.wwb

## Design Check Calculation Sheet Nordic Sizer – Canada 7.2

### Loads:

| Load  | Type | Distribution | Pat-<br>tern | Location [ft]<br>Start End | Magnitude<br>Start End | Unit |
|-------|------|--------------|--------------|----------------------------|------------------------|------|
| Load1 | Dead | Full Area    |              |                            | 20.00                  | psf  |
| Load2 | Live | Full Area    |              |                            | 40.00                  | psf  |

### Maximum Reactions (lbs) and Support Bearing (in):

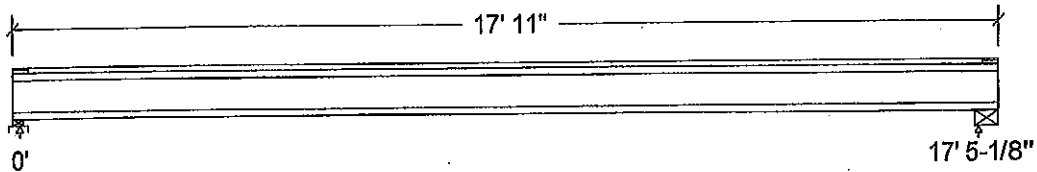

|             |       |  |       |
|-------------|-------|--|-------|
| Unfactored: |       |  |       |
| Dead        | 174   |  | 174   |
| Live        | 349   |  | 349   |
| Factored:   |       |  |       |
| Total       | 741   |  | 741   |
| Bearing:    |       |  |       |
| Capacity    |       |  | 1893  |
| Joist       | 1893  |  | -     |
| Support     | 5573  |  | -     |
| Des ratio   |       |  | 0.39  |
| Joist       | 0.39  |  | -     |
| Support     | 0.13  |  | -     |
| Load case   | #2    |  | #2    |
| Length      | 2-3/8 |  | 5-1/4 |
| Min req'd   | 1-3/4 |  | 1-3/4 |
| Stiffener   | No    |  | No    |
| KD          | 1.00  |  | 1.00  |
| KB support  | 1.00  |  | -     |
| fcp sup     | 769   |  | -     |
| Kzcp sup    | 1.09  |  | -     |

### Nordic 9-1/2" NI-80 Floor joist @ 12" o.c.

Supports: 1 - Lumber Sill plate, No.1/No.2; 2 - Steel Beam, W;

Total length: 17' 11"; Clear span: 17' 3-3/8"; 3/4" nailed and glued OSB sheathing

**This section PASSES the design code check.**



888 80.4411/24-20  
STRUCTURAL  
COMPONENT ONLY

**Limit States Design using CSA 086-14 and Vibration Criterion:**

| Criterion    | Analysis Value      | Design Value    | Unit   | Analysis/Design  |
|--------------|---------------------|-----------------|--------|------------------|
| Shear        | $V_f = 741$         | $V_r = 1895$    | lbs    | $V_f/V_r = 0.39$ |
| Moment(+)    | $M_f = 3227$        | $M_r = 8958$    | lbs-ft | $M_f/M_r = 0.36$ |
| Perm. Defl'n | $0.13 = < L/999$    | $0.58 = L/360$  | in     | 0.22             |
| Live Defl'n  | $0.25 = L/834$      | $0.44 = L/480$  | in     | 0.58             |
| Total Defl'n | $0.38 = L/556$      | $0.87 = L/240$  | in     | 0.43             |
| Bare Defl'n  | $0.29 = L/732$      | $0.58 = L/360$  | in     | 0.49             |
| Vibration    | $L_{max} = 17'-5.1$ | $L_v = 18'-4.9$ | ft     | 0.95             |
| Defl'n       | $= 0.031$           | $= 0.036$       | in     | 0.85             |

**Additional Data:**

| FACTORS: | f/E           | KD   | KH   | KZ | KL    | KT | KS | KN | LC# |
|----------|---------------|------|------|----|-------|----|----|----|-----|
| Vr       | 1895          | 1.00 | 1.00 | -  | -     | -  | -  | -  | #2  |
| Mr+      | 8958          | 1.00 | 1.00 | -  | 1.000 | -  | -  | -  | #2  |
| EI       | 324.1 million | -    | -    | -  | -     | -  | -  | -  | #2  |

**CRITICAL LOAD COMBINATIONS:**

Shear : LC #2 = 1.25D + 1.5L

Moment(+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth, groundwater E=earthquake

L=live(use, occupancy) Ls=live(storage, equipment) f=fire

Load Patterns: s=S/2 L=L+Ls =no pattern load in this span

All Load Combinations (LCs) are listed in the Analysis output

**CALCULATIONS:** $EI_{eff} = 375.38 \text{ lb-in}^2$   $K = 4.94e06 \text{ lbs}$ 

"Live" deflection is due to all non-dead loads (live, wind, snow...) CONFORMS TO OBC 2012

AMENDED 2020

**Design Notes:**

1. WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4, and the CSA 086-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to Nordic Structures technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



WWG NO. YAM12124-20  
STRUCTURAL  
COMPONENT ONLY

# NORDIC STRUCTURES

**COMPANY**  
Aug. 20, 2020 09:28

**PROJECT**  
J9 2ND FLOOR.wwb


## Design Check Calculation Sheet

Nordic Sizer – Canada 7.2

### Loads:

| Load  | Type | Distribution | Pat-tern | Location [ft]<br>Start End | Magnitude<br>Start End | Unit |
|-------|------|--------------|----------|----------------------------|------------------------|------|
| Load1 | Dead | Full Area    |          |                            | 20.00                  | psf  |
| Load2 | Live | Full Area    |          |                            | 40.00                  | psf  |

### Maximum Reactions (lbs) and Support Bearing (in):

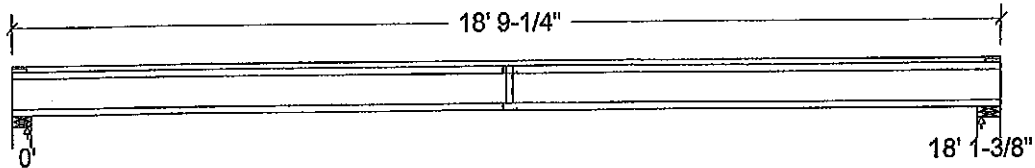

|             |       |  |       |
|-------------|-------|--|-------|
| Unfactored: |       |  |       |
| Dead        | 181   |  | 181   |
| Live        | 362   |  | 362   |
| Factored:   |       |  |       |
| Total       | 770   |  | 770   |
| Bearing:    |       |  |       |
| Capacity    |       |  |       |
| Joist       | 1893  |  | 1893  |
| Support     | 10841 |  | 12995 |
| Des ratio   |       |  |       |
| Joist       | 0.41  |  | 0.41  |
| Support     | 0.07  |  | 0.06  |
| Load case   | #2    |  | #2    |
| Length      | 4-3/8 |  | 5-1/4 |
| Min req'd   | 1-3/4 |  | 1-3/4 |
| Stiffener   | No    |  | No    |
| KD          | 1.00  |  | 1.00  |
| KB support  | -     |  | -     |
| fcp sup     | 769   |  | 769   |
| Kzcp sup    | -     |  | -     |


Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

### Nordic 9-1/2" NI-80 Floor joist @ 12" o.c.

Supports: All - Lumber Wall, No.1/No.2

Total length: 18' 9-1/4"; Clear span: 17' 11-5/8"; 5/8" nailed and glued OSB sheathing with 1 row of blocking and 1/2" gypsum ceiling

**This section PASSES the design code check.**



8616  
OWN NO. TAN 12/25-20  
**STRUCTURAL**  
CONCRETE DIV



## Limit States Design using CSA O86-14 and Vibration Criterion:

| Criterion    | Analysis Value      | Design Value    | Unit   | Analysis/Design  |
|--------------|---------------------|-----------------|--------|------------------|
| Shear        | $V_f = 770$         | $V_r = 1895$    | lbs    | $V_f/V_r = 0.41$ |
| Moment(+)    | $M_f = 3486$        | $M_r = 8958$    | lbs-ft | $M_f/M_r = 0.39$ |
| Perm. Defl'n | $0.15 = < L/999$    | $0.60 = L/360$  | in     | 0.24             |
| Live Defl'n  | $0.30 = L/735$      | $0.45 = L/480$  | in     | 0.65             |
| Total Defl'n | $0.44 = L/490$      | $0.91 = L/240$  | in     | 0.49             |
| Bare Defl'n  | $0.33 = L/656$      | $0.60 = L/360$  | in     | 0.55             |
| Vibration    | $L_{max} = 18'-1.4$ | $L_v = 20'-0.5$ | ft     | 0.90             |
| Defl'n       | $= 0.027$           | $= 0.034$       | in     | 0.80             |

## Additional Data:

| FACTORS: | f/E           | KD   | KH   | KZ | KL    | KT | KS | KN | LC# |
|----------|---------------|------|------|----|-------|----|----|----|-----|
| Vr       | 1895          | 1.00 | 1.00 | -  | -     | -  | -  | -  | #2  |
| Mr+      | 8958          | 1.00 | 1.00 | -  | 1.000 | -  | -  | -  | #2  |
| EI       | 324.1 million | -    | -    | -  | -     | -  | -  | -  | #2  |

## CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L

Moment(+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth, groundwater E=earthquake

L=live(use, occupancy) Ls=live(storage, equipment) f=fire

Load Patterns: s=S/2 L=L+Ls =no pattern load in this span

All Load Combinations (LCs) are listed in the Analysis output

## CALCULATIONS:


 $EI_{eff} = 367.27 \text{ lb-in}^2$   $K = 4.94e06 \text{ lbs}$ 

"Live" deflection is due to all non-dead loads (live, wind, snow...) CONFORMS TO OBC 2012

AMENDED 2020

## Design Notes:

1. WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4, and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to Nordic Structures technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.

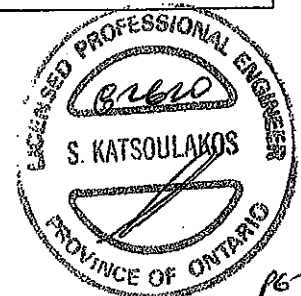

16-2  
 DWG NO. TAW12125-20  
 STRUCTURAL  
 COMPONENT ONLY

# NORDIC STRUCTURES

**COMPANY**  
Aug: 20, 2020 09:27


**PROJECT**  
J10 2ND FLOOR.wwb

## Design Check Calculation Sheet Nordic Sizer - Canada 7.2

### Loads:

| Load  | Type | Distribution | Pat-tern | Location [ft]<br>Start End | Magnitude<br>Start End | Unit |
|-------|------|--------------|----------|----------------------------|------------------------|------|
| Load1 | Dead | Full Area    |          |                            | 20.00                  | psf  |
| Load2 | Live | Full Area    |          |                            | 40.00                  | psf  |

### Maximum Reactions (lbs) and Support Bearing (in):

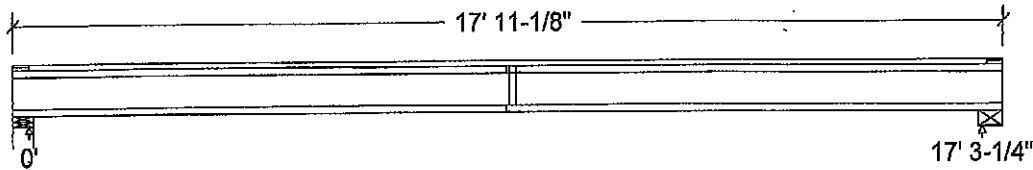

|             |       |  |       |
|-------------|-------|--|-------|
| Unfactored: |       |  |       |
| Dead        | 173   |  | 173   |
| Live        | 345   |  | 345   |
| Factored:   |       |  |       |
| Total       | 734   |  | 734   |
| Bearing:    |       |  |       |
| Capacity    |       |  |       |
| Joist       | 1893  |  | 1893  |
| Support     | 10841 |  | -     |
| Des ratio   |       |  |       |
| Joist       | 0.39  |  | 0.39  |
| Support     | 0.07  |  | -     |
| Load case   | #2    |  | #2    |
| Length      | 4-3/8 |  | 5-1/4 |
| Min req'd   | 1-3/4 |  | 1-3/4 |
| Stiffener   | No    |  | No    |
| KD          | 1.00  |  | 1.00  |
| KB support  | -     |  | -     |
| fcg sup     | 769   |  | -     |
| Kzcp sup    | -     |  | -     |


Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

### Nordic 9-1/2" NI-80 Floor joist @ 12" o.c.

Supports: 1 - Lumber Wall, No.1/No.2; 2 - Steel Beam, W;

Total length: 17' 11-1/8"; Clear span: 17' 1-1/2"; 5/8" nailed and glued OSB sheathing with 1 row of blocking and 1/2" gypsum ceiling

**This section PASSES the design code check.**



DWG NO. YAM/2126-20  
STRUCTURAL  
COMPONENT ONLY

**Limit States Design using CSA O86-14 and Vibration Criterion:**

| Criterion    | Analysis Value      | Design Value    | Unit   | Analysis/Design  |
|--------------|---------------------|-----------------|--------|------------------|
| Shear        | $V_f = 734$         | $V_r = 1895$    | lbs    | $V_f/V_r = 0.39$ |
| Moment (+)   | $M_f = 3169$        | $M_r = 8958$    | lbs-ft | $M_f/M_r = 0.35$ |
| Perm. Defl'n | $0.12 = L/999$      | $0.58 = L/360$  | in     | 0.21             |
| Live Defl'n  | $0.25 = L/839$      | $0.43 = L/480$  | in     | 0.57             |
| Total Defl'n | $0.37 = L/559$      | $0.86 = L/240$  | in     | 0.43             |
| Bare Defl'n  | $0.28 = L/750$      | $0.58 = L/360$  | in     | 0.48             |
| Vibration    | $L_{max} = 17'-3.3$ | $L_v = 20'-0.5$ | ft     | 0.86             |
| Defl'n       | $= 0.025$           | $= 0.036$       | in     | 0.70             |

**Additional Data:**

| FACTORS: | f/E           | KD   | KH   | KZ | KL    | KT | KS | KN | LC# |
|----------|---------------|------|------|----|-------|----|----|----|-----|
| $V_r$    | 1895          | 1.00 | 1.00 | -  | -     | -  | -  | -  | #2  |
| $M_r$    | 8958          | 1.00 | 1.00 | -  | 1.000 | -  | -  | -  | #2  |
| EI       | 324.1 million | -    | -    | -  | -     | -  | -  | -  | #2  |

**CRITICAL LOAD COMBINATIONS:**

Shear : LC #2 = 1.25D + 1.5L

Moment (+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth, groundwater E=earthquake

L=live (use, occupancy) Ls=live (storage, equipment) f=fire

Load Patterns: s=S/2 L=L+Ls =no pattern load in this span

All Load Combinations (LCs) are listed in the Analysis output

**CALCULATIONS:** $EI_{eff} = 367.27 \text{ lb-in}^2$   $K = 4.94e06 \text{ lbs}$ 


"Live" deflection is due to all non-dead loads (live, wind, snow...)

CONFORMS TO OBC 2012

**Design Notes:**

AMENDED 2020

1. WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4, and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to Nordic Structures technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.

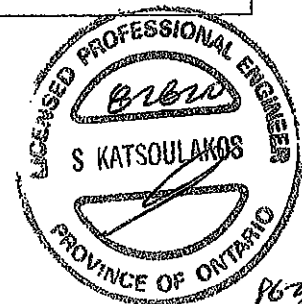

9674  
 DWG NO. TAN/2/26-20  
 STRUCTURAL  
 COMPONENT ONLY

# NORDIC STRUCTURES

COMPANY  
Apr. 9, 2020 09:52


PROJECT  
J1 2ND FLOOR.wwb

## Design Check Calculation Sheet Nordic Sizer - Canada 7.2

### Loads:

| Load  | Type | Distribution | Pat-tern | Location [ft]<br>Start End | Magnitude<br>Start End | Unit |
|-------|------|--------------|----------|----------------------------|------------------------|------|
| Load1 | Dead | Full Area    |          |                            | 20.00                  | psf  |
| Load2 | Live | Full Area    |          |                            | 40.00                  | psf  |

### Maximum Reactions (lbs) and Support Bearing (In):

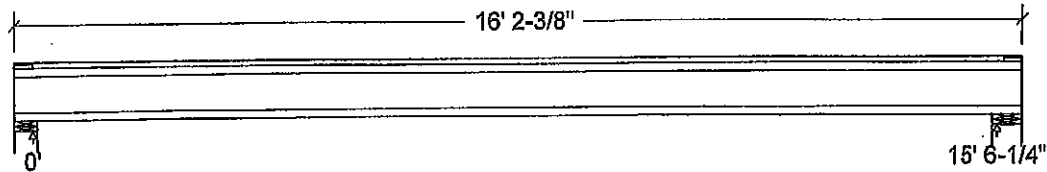

|             |       |  |       |
|-------------|-------|--|-------|
| Unfactored: |       |  |       |
| Dead        | 155   |  | 155   |
| Live        | 310   |  | 310   |
| Factored:   |       |  |       |
| Total       | 660   |  | 660   |
| Bearing:    |       |  |       |
| Capacity    |       |  |       |
| Joist       | 1893  |  | 1893  |
| Support     | 7744  |  | 9724  |
| Des ratio   |       |  |       |
| Joist       | 0.35  |  | 0.35  |
| Support     | 0.09  |  | 0.07  |
| Load case   | #2    |  | #2    |
| Length      | 4-3/8 |  | 5-1/2 |
| Min req'd   | 1-3/4 |  | 1-3/4 |
| Stiffener   | No    |  | No    |
| KD          | 1.00  |  | 1.00  |
| KB support  | -     |  | -     |
| fcp sup     | 769   |  | 769   |
| Kzcp sup    | -     |  | -     |

Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

### Nordic 9-1/2" NI-40x Floor joist @ 12" o.c.


Supports: All - Lumber Wall, No.1/No.2

Total length: 16' 2-3/8"; Clear span: 15' 4-1/2"; 5/8" nailed and glued OSB sheathing with 1/2" gypsum ceiling

This section PASSES the design code check.

### Limit States Design using CSA O86-14 and Vibration Criterion:

| Criterion    | Analysis Value | Design Value | Unit   | Analysis/Design |
|--------------|----------------|--------------|--------|-----------------|
| Shear        | Vf = 660       | Vr = 1895    | lbs    | Vf/Vr = 0.35    |
| Moment(+)    | Mf = 2559      | Mr = 4824    | lbs-ft | Mf/Mr = 0.53    |
| Perm. Defl'n | 0.11 = < L/999 | 0.52 = L/360 | in     | 0.22            |
| Live Defl'n  | 0.23 = L/825   | 0.39 = L/480 | in     | 0.58            |
| Total Defl'n | 0.34 = L/550   | 0.78 = L/240 | in     | 0.44            |
| Bare Defl'n  | 0.26 = L/708   | 0.52 = L/360 | in     | 0.51            |
| Vibration    | Lmax = 15'-6.3 | Lv = 16'-8.5 | ft     | 0.93            |
| Defl'n       | = 0.033        | = 0.042      | in     | 0.79            |

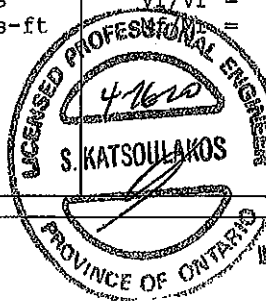

WWW.NO.1AW6063-20  
STRUCTURAL

**Additional Data:**

| FACTORS: | f/E           | KD   | KH   | KZ | KL    | KT | KS | KN | LC# |
|----------|---------------|------|------|----|-------|----|----|----|-----|
| Vr       | 1895          | 1.00 | 1.00 | -  | -     | -  | -  | -  | #2  |
| Mr+      | 4824          | 1.00 | 1.00 | -  | 1.000 | -  | -  | -  | #2  |
| EI       | 218.1 million | -    | -    | -  | -     | -  | -  | -  | #2  |

**CRITICAL LOAD COMBINATIONS:**

Shear : LC #2 = 1.25D + 1.5L

Moment(+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake  
L=live(use,occupancy) Ls=live(storage,equipment) f=fire

Load Patterns: s=S/2 L=L+Ls =no pattern load in this span

All Load Combinations (LCs) are listed in the Analysis output

**CALCULATIONS:**E<sub>ieff</sub> = 258.29 lb-in<sup>2</sup> K= 4.94e06 lbs

"Live" deflection is due to all non-dead loads (live, wind, snow...)

CONFORMS TO OBC 2012

AMENDED 2020

**Design Notes:**

1. WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4, and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to Nordic Structures technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



NO. YAW 6063 -20  
STRUCTURAL  
COMPONENT ONLY

# NORDIC STRUCTURES

COMPANY  
Apr. 9, 2020 09:51


PROJECT  
J6 2ND FLOOR.wwb

## Design Check Calculation Sheet Nordic Sizer - Canada 7.2

### Loads:

| Load  | Type | Distribution | Pat-tern | Location [ft]<br>Start End | Magnitude<br>Start End | Unit |
|-------|------|--------------|----------|----------------------------|------------------------|------|
| Load1 | Dead | Full Area    |          |                            | 20.00                  | psf  |
| Load2 | Live | Full Area    |          |                            | 40.00                  | psf  |

### Maximum Reactions (lbs) and Support Bearing (in):

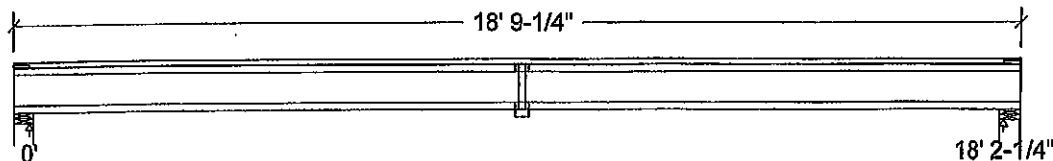

|             |       |  |       |
|-------------|-------|--|-------|
| Unfactored: |       |  |       |
| Dead        | 182   |  | 182   |
| Live        | 364   |  | 364   |
| Factored:   |       |  |       |
| Total       | 773   |  | 773   |
| Bearing:    |       |  |       |
| Capacity    |       |  |       |
| Joist       | 1893  |  | 1893  |
| Support     | 10841 |  | 10841 |
| Des ratio   |       |  |       |
| Joist       | 0.41  |  | 0.41  |
| Support     | 0.07  |  | 0.07  |
| Load case   | #2    |  | #2    |
| Length      | 4-3/8 |  | 4-3/8 |
| Min req'd   | 1-3/4 |  | 1-3/4 |
| Stiffener   | No    |  | No    |
| KD          | 1.00  |  | 1.00  |
| KB support  | -     |  | -     |
| fcg sup     | 769   |  | 769   |
| Kzcg sup    | -     |  | -     |

Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

### Nordic 9-1/2" NI-80 Floor joist @ 12" o.c.


Supports: All - Lumber Wall, No.1/No.2

Total length: 18' 9-1/4"; Clear span: 18' 1/2"; 5/8" nailed and glued OSB sheathing with 1 row of blocking; strapping at blocking locations and 1/2" gypsum ceiling

This section PASSES the design code check.

### Limit States Design using CSA O86-14 and Vibration Criterion:

| Criterion    | Analysis Value | Design Value | Unit   | Analysis/Design |
|--------------|----------------|--------------|--------|-----------------|
| Shear        | Vf = 773       | Vr = 1895    | lbs    | Vf/Vr = 0.41    |
| Moment (+)   | Mf = 3514      | Mr = 8958    | lbs-ft | Mf/Mr = 0.39    |
| Perm. Defl'n | 0.15 = < L/999 | 0.61 = L/360 | in     | 0.25            |
| Live Defl'n  | 0.30 = L/726   | 0.45 = L/480 | in     | 0.66            |
| Total Defl'n | 0.45 = L/484   | 0.91 = L/240 | in     | 0.50            |
| Bare Defl'n  | 0.34 = L/649   | 0.61 = L/360 | in     | 0.55            |
| Vibration    | Lmax = 18'-2.3 | Lv = 20'-0.5 | ft     | 0.81            |
| Defl'n       | = 0.028        | = 0.034      | in     |                 |

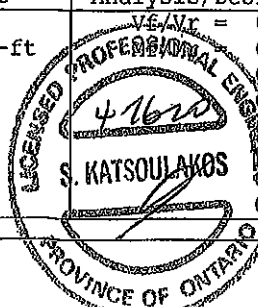

DWG NO. TAM 6064-20  
STRUCTURAL



**Additional Data:**

| FACTORS: | f/E           | KD   | KH   | KZ | KL    | KT | KS | KN | LC# |
|----------|---------------|------|------|----|-------|----|----|----|-----|
| Vr       | 1895          | 1.00 | 1.00 | -  | -     | -  | -  | -  | #2  |
| Mr+      | 8958          | 1.00 | 1.00 | -  | 1.000 | -  | -  | -  | #2  |
| EI       | 324.1 million | -    | -    | -  | -     | -  | -  | -  | #2  |

**CRITICAL LOAD COMBINATIONS:**

Shear : LC #2 = 1.25D + 1.5L

Moment(+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake  
L=live(use,occupancy) Is=live(storage,equipment) f=fire

Load Patterns: s=S/2 L=L+Ls \_=no pattern load in this span

All Load Combinations (LCs) are listed in the Analysis output

**CALCULATIONS:**E<sub>I</sub>eff = 367.27 lb-in<sup>2</sup> K= 4.94e06 lbs

"Live" deflection is due to all non-dead loads (live, wind, snow...)

CONFORMS TO OBC 2012

AMENDED 2020

**Design Notes:**

1. WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4, and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to Nordic Structures technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



HWB NO. TAM 6064-20  
STRUCTURAL  
COMPONENT ONLY

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 5 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B1(11498)

Specifier:

Designer:

Company:

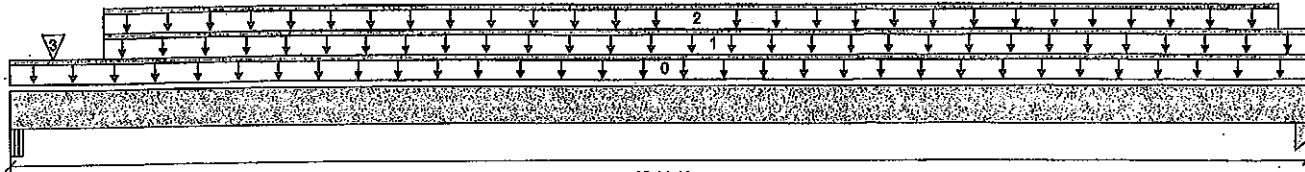

05-11-12

B1

B2

Total Horizontal Product Length = 05-11-12

**Reaction Summary (Down / Uplift) (lbs)**

| Bearing    | Live    | Dead    | Snow | Wind |
|------------|---------|---------|------|------|
| B1, 5-1/4" | 147 / 0 | 289 / 0 |      |      |
| B2, 1-3/4" | 77 / 0  | 228 / 0 |      |      |

**Load Summary**

| Tag | Description        | Load Type         | Ref. | Start    | End      | Loc. | Live | Dead | Snow | Wind | Tributary |
|-----|--------------------|-------------------|------|----------|----------|------|------|------|------|------|-----------|
| 0   | Self-Weight        | Unf. Lin. (lb/ft) | L    | 00-00-00 | 05-11-12 | Top  | 10   |      |      |      | 00-00-00  |
| 1   | FC1 Floor Material | Unf. Lin. (lb/ft) | L    | 00-05-04 | 05-11-12 | Top  | 27   | 14   |      |      | n/a       |
| 2   | WALL               | Unf. Lin. (lb/ft) | L    | 00-05-04 | 05-10-00 | Top  |      | 60   |      |      | n/a       |
| 3   | 12(1619)           | Conc. Pt. (lbs)   | L    | 00-02-08 | 00-02-08 | Top  | 72   | 60   |      |      | n/a       |

**Controls Summary**

|                       | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment           | 443 ft-lbs      | 15093 ft-lbs        | 2.9%              | 0    | 03-01-10 |
| End Shear             | 222 lbs         | 7521 lbs            | 3.0%              | 0    | 01-02-12 |
| Total Load Deflection | L/999 (0.005")  | n/a                 | n/a               | 4    | 03-01-10 |
| Live Load Deflection  | L/999 (0.001")  | n/a                 | n/a               | 5    | 03-01-10 |
| Max Defl.             | 0.005"          | n/a                 | n/a               | 4    | 03-01-10 |
| Span / Depth          | 7.0             |                     |                   |      |          |



DWG NO. TAM 6065-20

**STRUCTURAL  
COMPONENT ONLY**
**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of Input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

**Bearing Supports**

|    | Dim. (LxW)             | Demand  | Demand/Resistance Support | Demand/Resistance Member | Material    |
|----|------------------------|---------|---------------------------|--------------------------|-------------|
| B1 | Beam 5-1/4" x 3-1/2"   | 405 lbs | 7.9%                      | 2.8%                     | Unspecified |
| B2 | Column 1-3/4" x 3-1/2" | 319 lbs | 12.3%                     | 6.6%                     | Unspecified |

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.


Calculations assume member is fully braced.

 Resistance Factor phi has been applied to all presented results per CSA O86. **AMENDED 2020**

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

**CONFORMS TO OBC 2012**


PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 8" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code: WATERDOWN

Customer:

Code reports: CCMC 12472-R


File name: MOUNTAINASH 5 EL 1 DECK CONDITION.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B1A(1996)

Specifier:

Designer: AJ

Company:

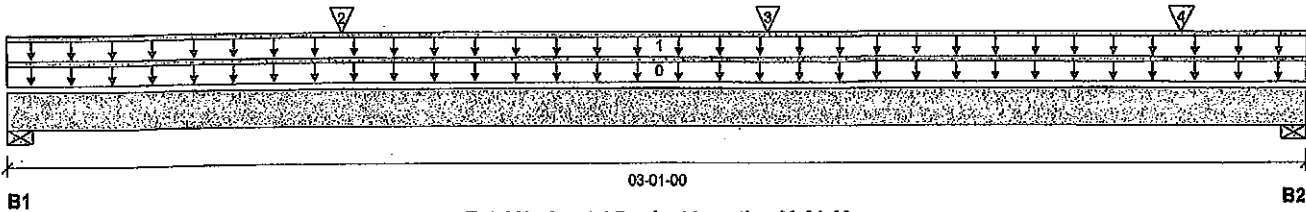

Total Horizontal Product Length = 03-01-00

### Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live     | Dead    | Snow | Wind |
|---------|----------|---------|------|------|
| B1, 3"  | 923 / 0  | 801 / 0 |      |      |
| B2, 3"  | 1134 / 0 | 706 / 0 |      |      |

### Load Summary

| Tag | Description | Load Type         | Ref. | Start    | End      | Loc. | Live | Dead | Snow | Wind | Tributary |
|-----|-------------|-------------------|------|----------|----------|------|------|------|------|------|-----------|
| 0   | Self-Weight | Unf. Lin. (lb/ft) | L    | 00-00-00 | 03-01-00 | Top  | 10   |      |      |      | 00-00-00  |
| 1   | E1(1402)    | Unf. Lin. (lb/ft) | L    | 00-00-00 | 03-01-00 | Top  | 337  | 250  |      |      | n/a       |
| 2   | J1(11927)   | Conc. Pt. (lbs)   | L    | 00-09-08 | 00-09-08 | Top  | 339  | 169  |      |      | n/a       |
| 3   | J1(11877)   | Conc. Pt. (lbs)   | L    | 01-09-08 | 01-09-08 | Top  | 339  | 169  |      |      | n/a       |
| 4   | J1(11942)   | Conc. Pt. (lbs)   | L    | 02-09-08 | 02-09-08 | Top  | 339  | 169  |      |      | n/a       |

### Controls Summary

|                       | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment           | 1386 ft-lbs     | 23220 ft-lbs        | 6.0%              | 1    | 01-08-06 |
| End Shear             | 1690 lbs        | 11571 lbs           | 14.6%             | 1    | 01-00-08 |
| Total Load Deflection | L/999 (0.003")  | n/a                 | n/a               | 4    | 01-06-11 |
| Live Load Deflection  | L/999 (0.002")  | n/a                 | n/a               | 5    | 01-06-11 |
| Max Defl.             | 0.003"          | n/a                 | n/a               | 4    | 01-06-11 |
| Span / Depth          | 3.4             |                     |                   |      |          |

### Bearing Supports

|    | Dim. (LxW)             | Demand   | Demand/Resistance Support | Demand/Resistance Member | Material        |
|----|------------------------|----------|---------------------------|--------------------------|-----------------|
| B1 | Wall/Plate 3" x 3-1/2" | 2135 lbs | 33.1%                     | 16.7%                    | Spruce-Pine-Fir |
| B2 | Wall/Plate 3" x 3-1/2" | 2583 lbs | 40.0%                     | 20.2%                    | Spruce-Pine-Fir |

### Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.


Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 8" O/C FOR MULTI-PLY NAILING, MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS



OWN NO. 7AM 6077-20

### STRUCTURAL COMPONENT ONLY Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



**Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP**  
**1ST FLR FRAMING\Flush Beams\B2(I3190) (Flush Beam)**

**PASSED**

BC CALC® Member Report

Dry | 1 span | No cant.

September 16, 2020 07:50:45

Build 7493

Job name:

File name: MOUNTAINASH 5

Address:

Description: 1ST FLR FRAMING\Flush Beams\B2(I3190)

City, Province, Postal Code: WATERDOWN


Specifier:

Customer:

Designer: AJ

Code reports: CCMC 12472-R

Company:

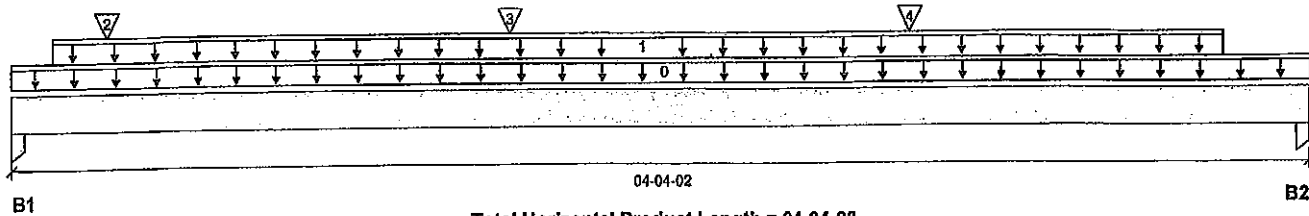

Total Horizontal Product Length = 04-04-02

**Reaction Summary (Down / Uplift) (lbs)**

| Bearing    | Live    | Dead    | Snow | Wind |
|------------|---------|---------|------|------|
| B1, 1-3/4" | 239 / 0 | 246 / 0 |      |      |
| B2, 3-1/2" | 182 / 0 | 219 / 0 |      |      |

**Load Summary**

| Tag | Description | Load Type         | Ref. | Start    | End      | Loc. | Live<br>1.00 | Dead<br>0.65 | Snow<br>1.00 | Wind<br>1.15 | Tributary |
|-----|-------------|-------------------|------|----------|----------|------|--------------|--------------|--------------|--------------|-----------|
| 0   | Self-Weight | Unf. Lin. (lb/ft) | L    | 00-00-00 | 04-04-02 | Top  |              | 5            |              |              | 00-00-00  |
| 1   | WALL        | Unf. Lin. (lb/ft) | L    | 00-01-12 | 04-00-10 | Top  |              | 60           |              |              | n/a       |
| 2   | J3(i3276)   | Conc. Pt. (lbs)   | L    | 00-03-14 | 00-03-14 | Top  | 105          | 52           |              |              | n/a       |
| 3   | J3(i3245)   | Conc. Pt. (lbs)   | L    | 01-07-14 | 01-07-14 | Top  | 158          | 79           |              |              | n/a       |
| 4   | J3(i2942)   | Conc. Pt. (lbs)   | L    | 02-11-14 | 02-11-14 | Top  | 158          | 79           |              |              | n/a       |

**Controls Summary**

|                       | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment           | 658 ft-lbs      | 11610 ft-lbs        | 5.7%              | 1    | 01-07-14 |
| End Shear             | 480 lbs         | 5785 lbs            | 8.3%              | 1    | 03-03-02 |
| Total Load Deflection | L/999 (0.006")  | n/a                 | n/a               | 4    | 02-01-06 |
| Live Load Deflection  | L/999 (0.003")  | n/a                 | n/a               | 5    | 02-01-06 |
| Max Defl.             | 0.006"          | n/a                 | n/a               | 4    | 02-01-06 |
| Span / Depth          | 5.1             |                     |                   |      |          |

| Bearing Supports | Dim. (LxW)      | Demand  | Demand/Resistance Support | Demand/Resistance Member | Material    |
|------------------|-----------------|---------|---------------------------|--------------------------|-------------|
| B1 Column        | 1-3/4" x 1-3/4" | 667 lbs | 26.8%                     | 17.9%                    | Unspecified |
| B2 Column        | 3-1/2" x 1-3/4" | 546 lbs | 11.0%                     | 7.3%                     | Unspecified |

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

**CONFORMS TO OBC 2012**

**AMENDED 2020**



DWG NO. 1AM12B91-20

**STRUCTURAL COMPONENT ONLY Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA).

Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®.

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 5 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B3(1455)

Specifier:

Designer:

Company:

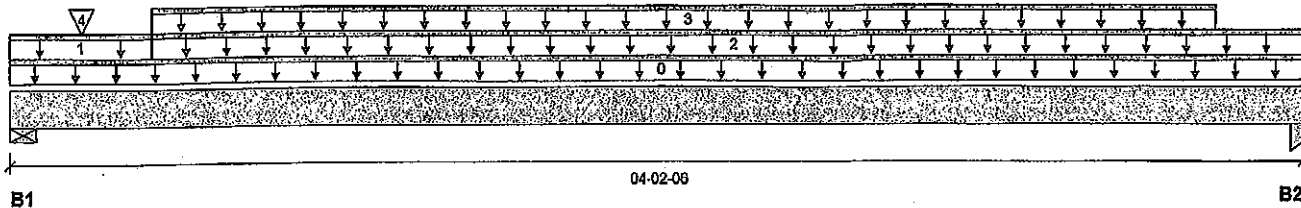

Total Horizontal Product Length = 04-02-06

**Reaction Summary (Down / Uplift) (lbs)**

| Bearing    | Live   | Dead    | Snow | Wind |
|------------|--------|---------|------|------|
| B1, 5-1/2" | 32 / 0 | 188 / 0 |      |      |
| B2, 3-1/2" | 19 / 0 | 123 / 0 |      |      |

**Load Summary**

| Tag | Description        | Load Type         | Ref. | Start    | End      | Loc. | Live | Dead | Snow | Wind | Tributary |
|-----|--------------------|-------------------|------|----------|----------|------|------|------|------|------|-----------|
| 0   | Self-Weight        | Unf. Lin. (lb/ft) | L    | 00-00-00 | 04-02-06 | Top  | 1.00 | 0.65 | 1.00 | 1.15 | 00-00-00  |
| 1   | FC1 Floor Material | Unf. Lin. (lb/ft) | L    | 00-00-00 | 00-05-08 | Top  | 8    |      |      |      | n/a       |
| 2   | FC1 Floor Material | Unf. Lin. (lb/ft) | L    | 00-05-08 | 04-02-06 | Top  | 9    | 5    |      |      | n/a       |
| 3   | WALL               | Unf. Lin. (lb/ft) | L    | 00-05-08 | 03-10-14 | Top  |      | 60   |      |      | n/a       |
| 4   | 10(I544)           | Conc. Pt. (lbs)   | L    | 00-02-12 | 00-02-12 | Top  | 12   | 64   |      |      | n/a       |

**Controls Summary**

|                       | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment           | 155 ft-lbs      | 7546 ft-lbs         | 2.1%              | 0    | 02-02-03 |
| End Shear             | 91 lbs          | 3761 lbs            | 2.4%              | 0    | 01-03-00 |
| Total Load Deflection | L/999 (0.001")  | n/a                 | n/a               | 4    | 02-02-03 |
| Live Load Deflection  | L/999 (0")      | n/a                 | n/a               | 5    | 02-02-03 |
| Max Defl.             | 0.001"          | n/a                 | n/a               | 4    | 02-02-03 |
| Span / Depth          | 4.5             |                     |                   |      |          |

| Bearing Supports | Dim. (LxW)                 | Demand  | Demand/Resistance Support | Demand/Resistance Member | Material        |
|------------------|----------------------------|---------|---------------------------|--------------------------|-----------------|
| B1               | Wall/Plate 5-1/2" x 1-3/4" | 263 lbs | 6.8%                      | 3.4%                     | Spruce-Pine-Fir |
| B2               | Column 3-1/2" x 1-3/4"     | 172 lbs | 6.6%                      | 3.5%                     | Unspecified     |

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020


 DWG NO. YAM 6067-20  
**STRUCTURAL COMPONENT ONLY**
**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

BG CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 5 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B4(1440)

Specifier:

Designer:

Company:

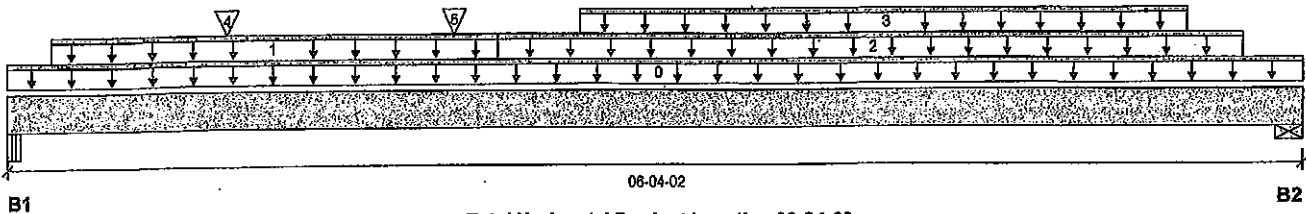
**Reaction Summary (Down / Uplift) (lbs)**

| Bearing    | Live     | Dead    | Snow | Wind |
|------------|----------|---------|------|------|
| B1, 5-1/4" | 1442 / 0 | 799 / 0 |      |      |
| B2, 3-1/2" | 1552 / 0 | 826 / 0 |      |      |

**Load Summary**

| Tag | Description        | Load Type         | Ref. | Start    | End      | Loc. | Live | Dead | Snow | Wind | Tributary |
|-----|--------------------|-------------------|------|----------|----------|------|------|------|------|------|-----------|
| 0   | Self-Weight        | Unf. Lin. (lb/ft) | L    | 00-00-00 | 06-04-02 | Top  | 10   | 0.65 | 1.00 | 1.15 | 00-00-00  |
| 1   | FC1 Floor Material | Unf. Lin. (lb/ft) | L    | 00-02-10 | 02-04-10 | Top  | 26   | 13   |      |      | n/a       |
| 2   | STAIR              | Unf. Lin. (lb/ft) | L    | 02-04-10 | 06-00-10 | Top  | 240  | 120  |      |      | n/a       |
| 3   | Smoothed Load      | Unf. Lin. (lb/ft) | L    | 02-09-06 | 05-09-06 | Top  | 341  | 170  |      |      | n/a       |
| 4   | J1(1486)           | Conc. Pt. (lbs)   | L    | 01-00-14 | 01-00-14 | Top  | 316  | 158  |      |      | n/a       |
| 5   | -                  | Conc. Pt. (lbs)   | L    | 02-02-01 | 02-02-01 | Top  | 695  | 415  |      |      | n/a       |

**Controls Summary**

|                       | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment           | 5363 ft-lbs     | 23220 ft-lbs        | 23.1%             | 1    | 03-03-06 |
| End Shear             | 2948 lbs        | 11671 lbs           | 25.5%             | 1    | 01-02-12 |
| Total Load Deflection | L/999 (0.044")  | n/a                 | n/a               | 4    | 03-03-06 |
| Live Load Deflection  | L/999 (0.029")  | n/a                 | n/a               | 5    | 03-03-06 |
| Max Defl.             | 0.044"          | n/a                 | n/a               | 4    | 03-03-06 |
| Span / Depth          | 7.2             |                     |                   |      |          |

| Bearing Supports | Dim. (LxW)                 | Demand   | Demand/Resistance Support | Demand/Resistance Member | Material        |
|------------------|----------------------------|----------|---------------------------|--------------------------|-----------------|
| B1               | Beam 5-1/4" x 3-1/2"       | 3161 lbs | 40.3%                     | 14.1%                    | Unspecified     |
| B2               | Wall/Plate 3-1/2" x 3-1/2" | 3360 lbs | 44.6%                     | 22.5%                    | Spruce-Pine-Fir |

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.


Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 8" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS

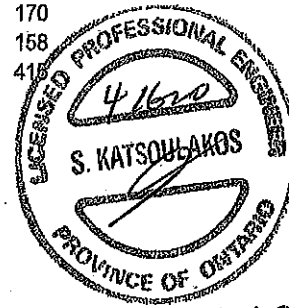
 BWC NO. TAM 6068-20  
 STRUCTURAL  
 COMPONENT ONLY

**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJST™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®.

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 5 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B5(11548)

Specifier:

Designer:

Company:

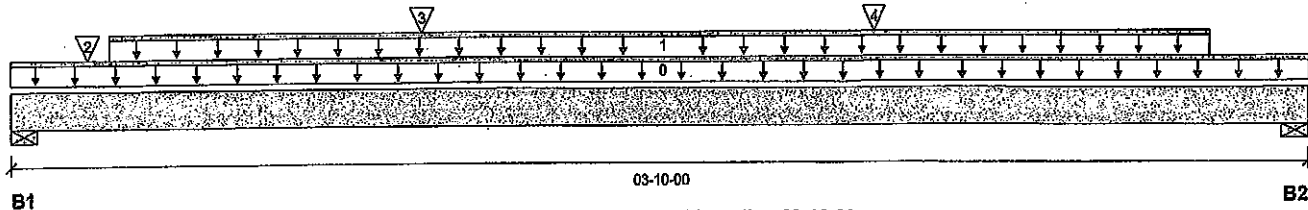

Total Horizontal Product Length = 03-10-00

**Reaction Summary (Down / Uplift) (lbs)**

| Bearing    | Live     | Dead    | Snow | Wind |
|------------|----------|---------|------|------|
| B1, 3-1/2" | 1050 / 0 | 535 / 0 |      |      |
| B2, 3-1/2" | 766 / 0  | 392 / 0 |      |      |

**Load Summary**

| Tag | Description | Load Type         | Ref. | Start    | End      | Loc. | Live | Dead | Snow | Wind | Tributary |
|-----|-------------|-------------------|------|----------|----------|------|------|------|------|------|-----------|
| 0   | Self-Weight | Unf. Lin. (lb/ft) | L    | 00-00-00 | 03-10-00 | Top  |      | 5    |      |      | 00-00-00  |
| 1   | STAIR       | Unf. Lin. (lb/ft) | L    | 00-03-08 | 03-06-08 | Top  | 240  | 120  |      |      | n/a       |
| 2   | J2(11488)   | Conc. Pt. (lbs)   | L    | 00-02-12 | 00-02-12 | Top  | 289  | 145  |      |      | n/a       |
| 3   | J2(11439)   | Conc. Pt. (lbs)   | L    | 01-02-08 | 01-02-08 | Top  | 341  | 171  |      |      | n/a       |
| 4   | J2(11540)   | Conc. Pt. (lbs)   | L    | 02-06-08 | 02-06-08 | Top  | 403  | 201  |      |      | n/a       |

**Controls Summary**

|                       | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment           | 1549 ft-lbs     | 11610 ft-lbs        | 13.3%             | 1    | 02-00-08 |
| End Shear             | 1228 lbs        | 5785 lbs            | 21.2%             | 1    | 02-09-00 |
| Total Load Deflection | L/999 (0.009")  | n/a                 | n/a               | 4    | 01-11-00 |
| Live Load Deflection  | L/999 (0.006")  | n/a                 | n/a               | 5    | 01-11-00 |
| Max Defl.             | 0.008"          | n/a                 | n/a               | 4    | 01-11-00 |
| Span / Depth          | 4.3             |                     |                   |      |          |

**Bearing Supports**

|    | Dim. (LxW)                 | Demand   | Demand/Resistance Support | Demand/Resistance Member | Material        |
|----|----------------------------|----------|---------------------------|--------------------------|-----------------|
| B1 | Wall/Plate 3-1/2" x 1-3/4" | 2244 lbs | 59.6%                     | 30.0%                    | Spruce-Pine-Fir |
| B2 | Wall/Plate 3-1/2" x 1-3/4" | 1639 lbs | 43.5%                     | 21.9%                    | Spruce-Pine-Fir |

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9


CONFORMS TO CBC 2012

AMENDED 2020


 OWS NO. YAW 6069-20  
**STRUCTURAL COMPONENT ONLY**
**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B6(11574) (Flush Beam)**

Dry | 1 span | No cant.

February 7, 2020 09:30:29

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 5 EL 1.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B6(11574)

Specifier:

Designer:

Company:

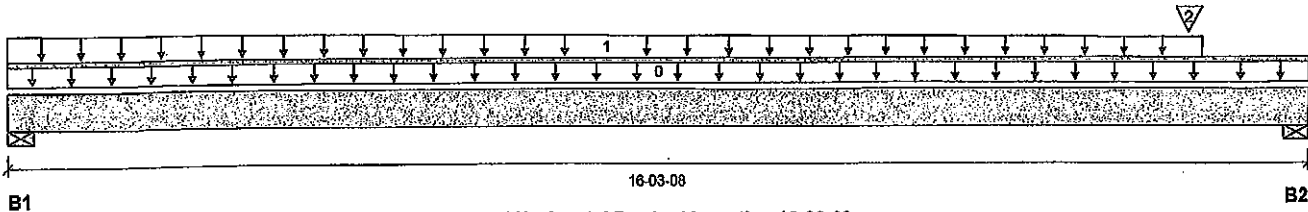**Reaction Summary (Down / Uplift) (lbs)**

| Bearing    | Live     | Dead    | Snow | Wind |
|------------|----------|---------|------|------|
| B1, 5-1/2" | 332 / 0  | 247 / 0 |      |      |
| B2, 5-1/2" | 1753 / 0 | 999 / 0 |      |      |

**Load Summary**

| Tag | Description        | Load Type           | Ref. | Start    | End      | Loc. | Live | Dead | Snow | Wind | Tributary |
|-----|--------------------|---------------------|------|----------|----------|------|------|------|------|------|-----------|
| 0   | Self-Weight        | Unf. Lin. (lb/ft)   | L    | 00-00-00 | 16-03-08 | Top  | 10   |      |      |      | 00-00-00  |
| 1   | FC2 Floor Material | Trapezoidal (lb/ft) | L    | 00-00-00 | 15-00-00 | Top  | 29   | 15   |      |      | n/a       |
| 2   | B6(11577)          | Conc. Pt. (lbs)     | L    | 14-10-04 | 14-10-04 | Top  | 1686 | 890  |      |      | n/a       |

**Controls Summary**

|                       | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment           | 4312 ft-lbs     | 23220 ft-lbs        | 18.6%             | 1    | 11-08-00 |
| End Shear             | 3844 lbs        | 11571 lbs           | 33.2%             | 1    | 15-00-08 |
| Total Load Deflection | L/703 (0.265")  | n/a                 | 34.1%             | 4    | 08-08-04 |
| Live Load Deflection  | L/1176 (0.158") | n/a                 | 30.6%             | 5    | 08-08-04 |
| Max Defl.             | 0.265"          | n/a                 | n/a               | 4    | 08-08-04 |
| Span / Depth          | 19.6            |                     |                   |      |          |

**Bearing Supports**

|    | Dim. (LxW)                 | Demand   | Demand/Resistance Support | Demand/Resistance Member | Material        |
|----|----------------------------|----------|---------------------------|--------------------------|-----------------|
| B1 | Wall/Plate 5-1/2" x 3-1/2" | 807 lbs  | 6.8%                      | 3.4%                     | Spruce-Pine-Fir |
| B2 | Wall/Plate 5-1/2" x 3-1/2" | 3877 lbs | 32.7%                     | 16.5%                    | Spruce-Pine-Fir |

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.


Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



PROVIDE 3 ROWS OF 3/8" ARDOX  
SPIRAL NAILS @ 12" O/C FOR  
MULTI-PLY NAILING. MAINTAIN  
A MIN. 2" LUMBER EDGE/END  
DISTANCE. DO NOT USE AIR NAILS

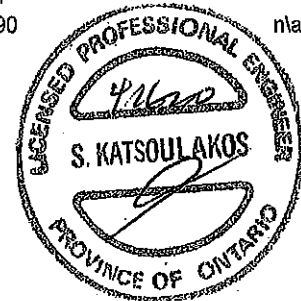

BWG NO. TAM 6073-20  
STRUCTURAL  
COMPONENT ONLY

**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA).

Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,




BC CALC® Member Report  
Build 7239  
Job name:  
Address:  
City, Province, Postal Code:  
Customer:  
Code reports: CCMC 12472-R

Dry | 1 span | No cant.

February 7, 2020 09:30:29

File name: MOUNTAINASH 5 EL 1.mmdl  
Description: 2ND FLR FRAMING\Dropped Beams\B7 DR(1989)  
Specifier:  
Designer:  
Company:

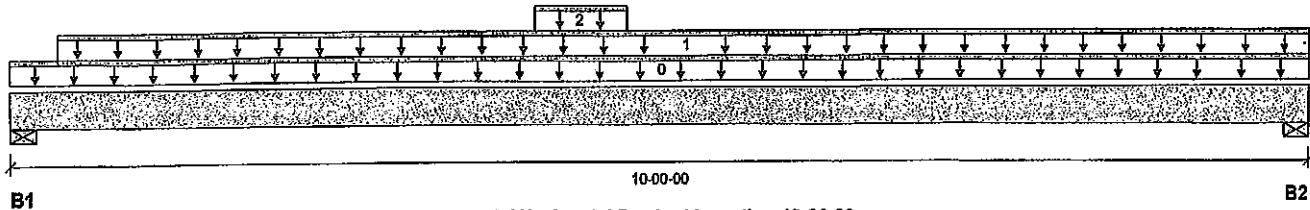

Total Horizontal Product Length = 10-00-00

### Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live     | Dead    | Snow | Wind |
|---------|----------|---------|------|------|
| B1, 4"  | 1592 / 0 | 888 / 0 |      |      |
| B2, 4"  | 1824 / 0 | 984 / 0 |      |      |

### Load Summary

| Tag | Description   | Load Type         | Ref. | Start    | End      | Loc. | Live | Dead | Snow | Wind | Tributary |
|-----|---------------|-------------------|------|----------|----------|------|------|------|------|------|-----------|
| 0   | Self-Weight   | Unf. Lin. (lb/ft) | L    | 00-00-00 | 10-00-00 | Top  | 14   |      |      |      | 00-00-00  |
| 1   | Smoothed Load | Unf. Lin. (lb/ft) | L    | 00-04-08 | 10-00-00 | Top  | 341  | 170  |      |      | n/a       |
| 2   | Bk2(1151)     | Unf. Lin. (lb/ft) | L    | 04-00-04 | 04-08-12 | Top  | 136  | 68   |      |      | n/a       |

### Controls Summary

|                       | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment           | 8666 ft-lbs     | 36222 ft-lbs        | 23.9%             | 1    | 04-10-08 |
| End Shear             | 3250 lbs        | 17356 lbs           | 18.7%             | 1    | 08-10-08 |
| Total Load Deflection | L/875 (0.13")   | n/a                 | 27.4%             | 4    | 05-00-00 |
| Live Load Deflection  | L/999 (0.084")  | n/a                 | n/a               | 5    | 05-00-00 |
| Max Defl.             | 0.13"           | n/a                 | n/a               | 4    | 05-00-00 |
| Span / Depth          | 11.9            |                     |                   |      |          |

### Bearing Supports


|    | Dim. (LxW)             | Demand   | Demand/Resistance Support | Demand/Resistance Member | Material        |
|----|------------------------|----------|---------------------------|--------------------------|-----------------|
| B1 | Wall/Plate 4" x 5-1/4" | 3474 lbs | 12.4%                     | 13.6%                    | Spruce-Pine-Fir |
| B2 | Wall/Plate 4" x 5-1/4" | 3967 lbs | 14.2%                     | 15.5%                    | Spruce-Pine-Fir |

### Notes

Design meets Code minimum (L/240) Total load deflection criteria.  
Design meets Code minimum (L/360) Live load deflection criteria.  
Calculations assume unbraced length of Top: 00-02-04, Bottom: 00-02-04.  
Resistance Factor phi has been applied to all presented results per CSA 086.  
BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA 086.  
Design based on Dry Service Condition.  
Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

AMENDED 2020



PROVIDE 3 ROWS OF 3/8" ARDOX  
SPIRAL NAILS @ 12" O/C FOR  
MULTI-PLY NAILING, MAINTAIN  
A MIN. 2" LUMBER EDGE/END  
DISTANCE. DO NOT USE AIR NAILS  
STAGGERED NAILS 6" BETWEEN PLYS



BOISE CASCADE 6070-20  
STRUCTURAL  
COMPONENT ONLY

### Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJSTM®, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 5 EL 1.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B8(11569)

Specifier:

Designer:

Company:

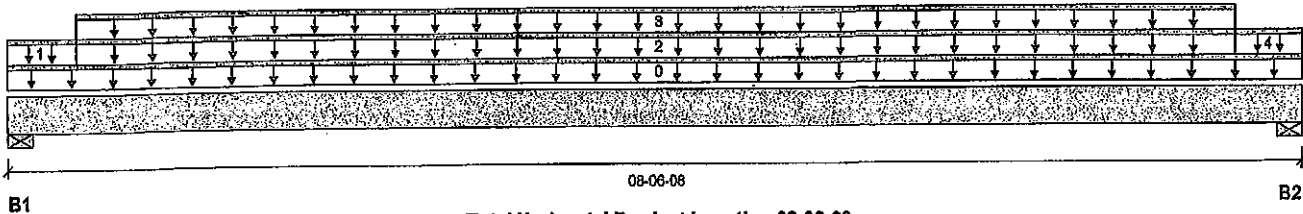
**Reaction Summary (Down / Uplift) (lbs)**

| Bearing    | Live   | Dead    | Snow | Wind |
|------------|--------|---------|------|------|
| B1, 5-1/2" | 32 / 0 | 265 / 0 |      |      |
| B2, 5-1/2" | 30 / 0 | 264 / 0 |      |      |

**Load Summary**

| Tag | Description        | Load Type         | Ref. | Start    | End      | Loc. | Live<br>1.00 | Dead<br>0.65 | Snow<br>1.00 | Wind<br>1.15 | Tributary |
|-----|--------------------|-------------------|------|----------|----------|------|--------------|--------------|--------------|--------------|-----------|
| 0   | Self-Weight        | Unf. Lin. (lb/ft) | L    | 00-00-00 | 08-06-08 | Top  |              | 5            |              |              | 00-00-00  |
| 1   | FC2 Floor Material | Unf. Lin. (lb/ft) | L    | 00-00-00 | 00-05-08 | Top  | 10           |              |              |              | n/a       |
| 2   | WALL               | Unf. Lin. (lb/ft) | L    | 00-05-08 | 08-01-00 | Top  |              | 60           |              |              | n/a       |
| 3   | FC2 Floor Material | Unf. Lin. (lb/ft) | L    | 00-05-08 | 08-01-00 | Top  | 7            | 4            |              |              | n/a       |
| 4   | FC2 Floor Material | Unf. Lin. (lb/ft) | L    | 08-01-00 | 08-06-08 | Top  | 6            |              |              |              | n/a       |

**Controls Summary**

|                       | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment           | 718 ft-lbs      | 7546 ft-lbs         | 9.5%              | 0    | 04-03-04 |
| End Shear             | 289 lbs         | 3761 lbs            | 7.7%              | 0    | 01-03-00 |
| Total Load Deflection | L/999 (0.024")  | n/a                 | n/a               | 4    | 04-03-04 |
| Live Load Deflection  | L/999 (0.002")  | n/a                 | n/a               | 5    | 04-03-04 |
| Max Defl.             | 0.024"          | n/a                 | n/a               | 4    | 04-03-04 |
| Span / Depth          | 9.8             |                     |                   |      |          |

| Bearing Supports | Dim. (LxW)                 | Demand  | Demand/Resistance Support | Demand/Resistance Member | Material        |
|------------------|----------------------------|---------|---------------------------|--------------------------|-----------------|
| B1               | Wall/Plate 5-1/2" x 1-3/4" | 371 lbs | 9.6%                      | 4.9%                     | Spruce-Pine-Fir |
| B2               | Wall/Plate 5-1/2" x 1-3/4" | 370 lbs | 9.6%                      | 4.8%                     | Spruce-Pine-Fir |

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020

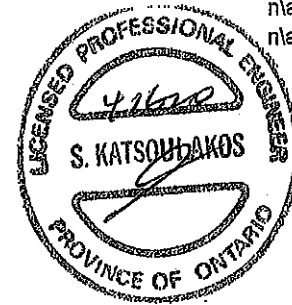

DWG NO. YAM 6074-20

**STRUCTURAL  
COMMENT ONLY  
Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 5 EL 1.mmd

Description: 2ND FLR FRAMING\Flush Beams\B9(11577)

Specifier:

Designer:

Company:

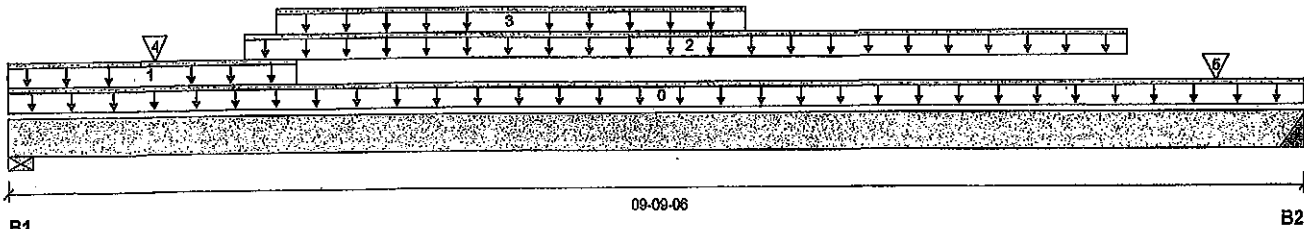

Total Horizontal Product Length = 09-09-06

**Reaction Summary (Down / Uplift) (lbs)**

| Bearing    | Live     | Dead     | Snow | Wind |
|------------|----------|----------|------|------|
| B1, 2-3/4" | 1918 / 0 | 1008 / 0 |      |      |
| B2, 4"     | 1730 / 0 | 914 / 0  |      |      |

**Load Summary**

| Tag | Description        | Load Type         | Ref. | Start    | End      | Loc. | Live<br>1.00 | Dead<br>0.65 | Snow<br>1.00 | Wind<br>1.15 | Tributary |
|-----|--------------------|-------------------|------|----------|----------|------|--------------|--------------|--------------|--------------|-----------|
| 0   | Self-Weight        | Unf. Lin. (lb/ft) | L    | 00-00-00 | 09-09-06 | Top  |              | 10           |              |              | 00-00-00  |
| 1   | FC2 Floor Material | Unf. Lin. (lb/ft) | L    | 00-00-00 | 02-01-14 | Top  | 23           | 11           |              |              | n/a       |
| 2   | Smoothed Load      | Unf. Lin. (lb/ft) | L    | 01-09-04 | 08-05-04 | Top  | 298          | 149          |              |              | n/a       |
| 3   | STAIR              | Unf. Lin. (lb/ft) | L    | 02-00-01 | 05-06-01 | Top  | 240          | 120          |              |              | n/a       |
| 4   | J2(i675)           | Conc. Pt. (lbs)   | L    | 01-01-04 | 01-01-04 | Top  | 451          | 225          |              |              | n/a       |
| 5   | J2(i673)           | Conc. Pt. (lbs)   | L    | 09-01-04 | 09-01-04 | Top  | 321          | 161          |              |              | n/a       |

**Controls Summary**

|                       | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment           | 10250 ft-lbs    | 23220 ft-lbs        | 44.1%             | 1    | 04-07-04 |
| End Shear             | 4076 lbs        | 11571 lbs           | 35.2%             | 1    | 01-00-04 |
| Total Load Deflection | L/501 (0.224")  | n/a                 | 47.9%             | 4    | 04-09-04 |
| Live Load Deflection  | L/763 (0.147")  | n/a                 | 47.2%             | 5    | 04-09-04 |
| Max Defl.             | 0.224"          | n/a                 | n/a               | 4    | 04-09-04 |
| Span / Depth          | 11.8            |                     |                   |      |          |

| Bearing Supports | Dim. (LxW)                 | Demand   | Demand/Resistance Support | Demand/Resistance Member | Material        |
|------------------|----------------------------|----------|---------------------------|--------------------------|-----------------|
| B1               | Wall/Plate 2-3/4" x 3-1/2" | 4138 lbs | 69.9%                     | 35.2%                    | Spruce-Pine-Fir |
| B2               | Hanger 4" x 3-1/2"         | 3738 lbs | n/a                       | 21.9%                    | HGUS410         |

**Cautions**

Header for the hanger HGUS410 at B2 is a Double 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF.  
Hanger model HGUS410 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.



**HWB NO. TAM 6075-20**  
**STRUCTURAL**  
**COMPONENT ONLY**



**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP**  
**2ND FLR FRAMING\Flush Beams\B9(11577) (Flush Beam)**

**PASSED**

BC CALC® Member Report

Dry | 1 span | No cant.

February 7, 2020 09:30:29

Build 7239

Job name:

File name: MOUNTAINASH 5 EL 1.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B9(11577)

City, Province, Postal Code:

Specifier:

Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

**CONFORMS TO OBC 2012**

**AMENDED 2020**



PROVIDE 3 ROWS OF 3/4" ARDOX  
SPIRAL NAILS @ 8" O/C FOR  
MULTI-PLY NAILING. MAINTAIN  
A MIN. 2" LUMBER EDGE/END  
DISTANCE. DO NOT USE AIR NAILS



BWG NO: YAM 6075-20  
**STRUCTURAL  
COMPONENT ONLY**

**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B10\11567\ (Flush Beam)**

Dry | 1 span | No cant.

February 7, 2020 09:30:29

BC CALC® Member Report

Build 7239

Job name:

File name: MOUNTAINASH 5 EL 1.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B10\11567\

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:



B1

01-04-08

B2

Total Horizontal Product Length = 01-04-08

**Reaction Summary (Down / Uplift) (lbs)**

| Bearing    | Live | Dead  | Snow | Wind |
|------------|------|-------|------|------|
| B1, 4"     |      | 6 / 0 |      |      |
| B2, 6-1/2" |      | 8 / 0 |      |      |

**Load Summary**

| Tag | Description | Load Type         | Ref. | Start    | End      | Loc. | Live | Dead | Snow | Wind | Tributary |
|-----|-------------|-------------------|------|----------|----------|------|------|------|------|------|-----------|
| 0   | Self-Weight | Unf. Lin. (lb/ft) | L    | 00-00-00 | 01-04-08 | Top  | 1.00 | 0.65 | 1.00 | 1.15 |           |
|     |             |                   |      |          |          |      |      | 10   |      |      | 00-00-00  |

**Controls Summary**

|              | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|--------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment  | 1 ft-lbs        | 15093 ft-lbs        | n/a               | 0    | 00-07-00 |
| End Shear    | 3 lbs           | 7521 lbs            | n/a               | 0    | 00-04-00 |
| Span / Depth | 0.8             |                     |                   |      |          |

**Bearing Supports**

|    | Dim. (LxW)                 | Demand | Demand/Resistance Support | Demand/Resistance Member | Material        |
|----|----------------------------|--------|---------------------------|--------------------------|-----------------|
| B1 | 4" x 3-1/2"                | 8 lbs  | n/a                       | n/a                      | HGUS410         |
| B2 | Wall/Plate 6-1/2" x 3-1/2" | 11 lbs | 0.1%                      | n/a                      | Spruce-Pine-Fir |

**Cautions**

Header for the hanger HGUS410 at B1 is a Double 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF.  
Hanger model HGUS410 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

**Notes**

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO CBC 2012

AMENDED 2020



PROVIDE 3 ROWS OF 3/8" ARDOX  
SPIRAL NAILS @ 6" O/C FOR  
MULTI-PLY NAILING. MAINTAIN  
A MIN. 2" LUMBER EDGE/END  
DISTANCE. DO NOT USE AIR NAILS



SWG NO. YAW 6071 -20  
STRUCTURAL  
COMPONENT ONLY

**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

BC CALC® Member Report

Dry | 1 span | No cant.

February 7, 2020 09:30:29

Build 7239

Job name:

File name: MOUNTAINASH 5 EL 1.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B13(I625) (Flush Beam)

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

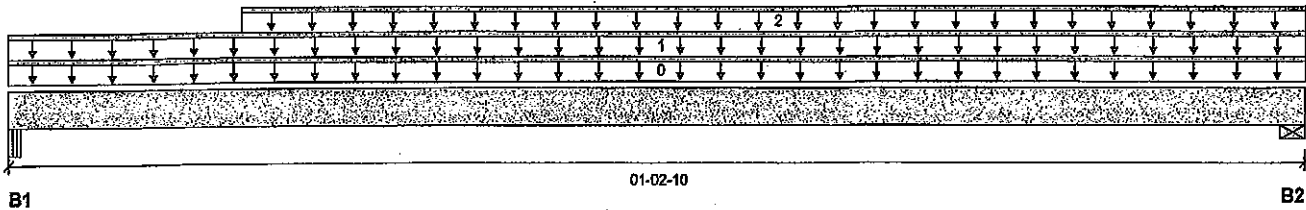

Total Horizontal Product Length = 01-02-10

### Reaction Summary (Down / Uplift) (lbs)

| Bearing    | Live   | Dead   | Snow    | Wind |
|------------|--------|--------|---------|------|
| B1, 2-5/8" | 42 / 0 | 41 / 0 | 72 / 0  |      |
| B2, 5-1/2" | 66 / 0 | 63 / 0 | 107 / 0 |      |

### Load Summary

| Tag | Description        | Load Type         | Ref. | Start    | End      | Loc. | Live | Dead | Snow | Wind | Tributary |
|-----|--------------------|-------------------|------|----------|----------|------|------|------|------|------|-----------|
| 0   | Self-Weight        | Unf. Lin. (lb/ft) | L    | 00-00-00 | 01-02-10 | Top  |      | 10   |      |      | 00-00-00  |
| 1   | ROOF               | Unf. Lin. (lb/ft) | L    | 00-00-00 | 01-02-10 | Top  | 77   | 70   | 147  |      | n/a       |
| 2   | FC2 Floor Material | Unf. Lin. (lb/ft) | L    | 00-02-10 | 01-02-10 | Top  | 14   | 7    |      |      | n/a       |

### Controls Summary

|              | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|--------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment  | 23 ft-lbs       | 23220 ft-lbs        | 0.1%              | 13   | 00-05-14 |
| End Shear    | 114 lbs         | 11571 lbs           | 1.0%              | 13   | 00-02-10 |
| Span / Depth | 0.8             |                     |                   |      |          |

### Bearing Supports

|    | Dim. (LxW)                 | Demand  | Demand/Resistance Support | Demand/Resistance Member | Material        |
|----|----------------------------|---------|---------------------------|--------------------------|-----------------|
| B1 | Beam 2-5/8" x 3-1/2"       | 201 lbs | 5.1%                      | 1.8%                     | Unspecified     |
| B2 | Wall/Plate 5-1/2" x 3-1/2" | 306 lbs | 2.6%                      | 1.3%                     | Spruce-Pine-Fir |

### Notes

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.


Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO CBC 2012

AMENDED 2020



PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 4" O/C FOR MULTI-PLY NAILING, MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS



SWR NO. TAM 6024-20

STRUCTURAL

COMPONENT ONLY

### Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA).

Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

BC CALC® Member Report

Dry | 2 spans | No cant.

February 7, 2020 10:01:17

Build 7239

Job name:

File name: MOUNTAINASH 5 EL 3.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B15(11694)

City, Province, Postal Code: WATERDOWN


Specfier:

Customer:

Designer: AJ

Code reports: CCMC 12472-R

Company:

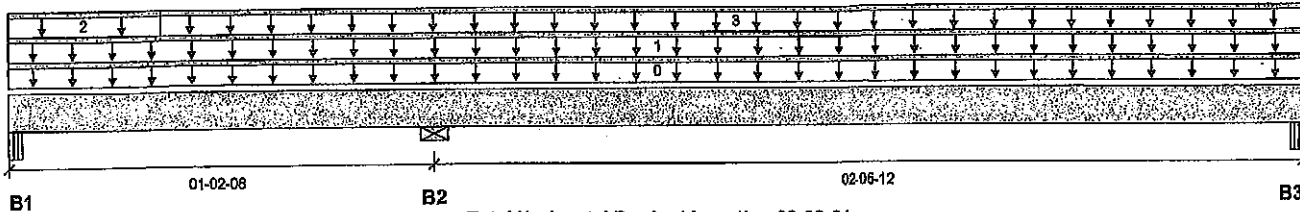

Total Horizontal Product Length = 03-08-04

### Reaction Summary (Down / Uplift) (lbs)

| Bearing    | Live    | Dead    | Snow    | Wind |
|------------|---------|---------|---------|------|
| B1, 5-1/4" | 77 / 47 | 27 / 0  | 77 / 14 |      |
| B2, 5-1/2" | 215 / 0 | 197 / 0 | 320 / 0 |      |
| B3, 5-1/4" | 122 / 1 | 111 / 0 | 181 / 0 |      |

### Load Summary

| Tag | Description        | Load Type         | Ref. | Start    | End      | Loc. | Live | Dead | Snow | Wind | Tributary |
|-----|--------------------|-------------------|------|----------|----------|------|------|------|------|------|-----------|
| 0   | Self-Weight        | Unf. Lin. (lb/ft) | L    | 00-00-00 | 03-08-04 | Top  | 1.00 | 0.65 | 1.00 | 1.15 | 00-00-00  |
| 1   | ROOF               | Unf. Lin. (lb/ft) | L    | 00-00-00 | 03-08-04 | Top  | 77   | 70   | 147  |      | n/a       |
| 2   | FC2 Floor Material | Unf. Lin. (lb/ft) | L    | 00-00-00 | 00-05-04 | Top  | 27   | 13   |      |      | n/a       |
| 3   | FC2 Floor Material | Unf. Lin. (lb/ft) | L    | 00-05-04 | 03-08-04 | Top  | 22   | 11   |      |      | n/a       |

### Controls Summary

|                       | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment           | 159 ft-lbs      | 23220 ft-lbs        | 0.7%              | 66   | 02-05-08 |
| Neg. Moment           | -182 ft-lbs     | -23220 ft-lbs       | 0.8%              | 49   | 01-02-08 |
| End Shear             | 134 lbs         | 11571 lbs           | 1.2%              | 18   | 00-05-04 |
| Cont. Shear           | 299 lbs         | 11571 lbs           | 2.6%              | 67   | 00-11-12 |
| Total Load Deflection | L/999 (0")      | n/a                 | n/a               | 126  | 02-04-05 |
| Live Load Deflection  | L/999 (0")      | n/a                 | n/a               | 178  | 02-04-05 |
| Max Defl.             | 0"              | n/a                 | n/a               | 128  | 02-04-05 |
| Span / Depth          | 2.7             |                     |                   |      |          |

| Bearing Supports | Dim. (LxW)                 | Demand  | Demand/Resistance Support | Demand/Resistance Member | Material        |
|------------------|----------------------------|---------|---------------------------|--------------------------|-----------------|
| B1               | Beam 5-1/4" x 3-1/2"       | 227 lbs | 2.3%                      | 1.0%                     | Unspecified     |
| B2               | Wall/Plate 5-1/2" x 3-1/2" | 940 lbs | 7.9%                      | 4.0%                     | Spruce-Pine-Fir |
| B3               | Beam 5-1/4" x 3-1/2"       | 533 lbs | 5.4%                      | 2.4%                     | Unspecified     |

### Cautions

Uplift of 60 lbs found at bearing B1. (SIMPSON 2-H254 @ B1. B1)



BWR NO. TAM 6076-20  
STRUCTURAL  
COMPONENT ONLY



**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP**  
**2ND FLR FRAMING\Flush Beams\B15(I1694) (Flush Beam)**

**PASSED**

BC CALC® Member Report

Dry | 2 spans | No cant.

February 7, 2020 10:01:17

Build 7239

Job name:

Address:

City, Province, Postal Code: WATERDOWN

Customer:

Code reports: CCMC 12472-R

File name: MOUNTAINASH 5 EL 3.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B15(I1694)

Specifier:

Designer: AJ

Company:

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.


Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

**CONFORMS TO OBC 2012**

**AMENDED 2020**



PROVIDE 3 ROWS OF 3/4" ARDOX  
SPIRAL NAILS @ 8" O/C FOR  
MULTI-PLY NAILING. MAINTAIN  
A MIN. 2" LUMBER EDGE/END  
DISTANCE. DO NOT USE AIR NAILS



DWG NO. YAM 6076-20  
**STRUCTURAL  
COMPONENT ONLY**

**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™,  
ALLJOIST®, BC RIM BOARD™, BCI®,  
BOISE GLULAM™, BC FloorValue®,  
VERSA-LAM®, VERSA-RIM PLUS®,





**Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP**  
**1ST FLR FRAMING\Flush Beams\B16 H(I2851) (Flush Beam)**

**PASSED**

BC CALC® Member Report

Dry | 1 span | No cant.

September 16, 2020 07:50:45

Build 7493

Job name:

File name: MOUNTAINASH 5

Address:

Description: 1ST FLR FRAMING\Flush Beams\B16 H(I2851)

City, Province, Postal Code: WATERDOWN


Specifier:

Customer:

Designer: AJ

Code reports: CCMC 12472-R

Company:

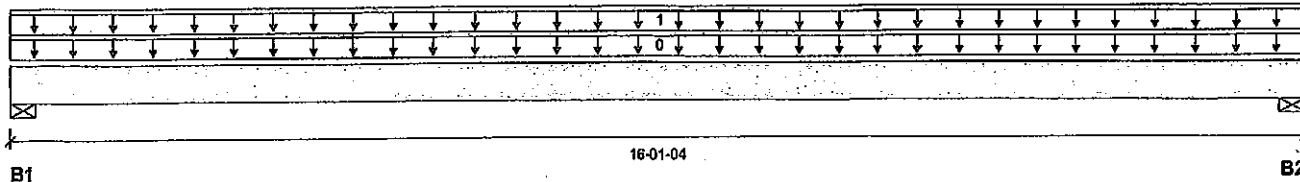

Total Horizontal Product Length = 16-01-04

**Reaction Summary (Down / Uplift) (lbs)**

| Bearing    | Live   | Dead   | Snow | Wind |
|------------|--------|--------|------|------|
| B1, 1-7/8" | 70 / 0 | 73 / 0 |      |      |
| B2, 4-3/8" | 71 / 0 | 75 / 0 |      |      |

**Load Summary**

| Tag | Description        | Load Type         | Ref. | Start    | End      | Loc. | Live | Dead | Snow | Wind | Tributary |
|-----|--------------------|-------------------|------|----------|----------|------|------|------|------|------|-----------|
| 0   | Self-Weight        | Unf. Lin. (lb/ft) | L    | 00-00-00 | 16-01-04 | Top  | 1.00 | 0.65 | 1.00 | 1.15 | 00-00-00  |
| 1   | FC1 Floor Material | Unf. Lin. (lb/ft) | L    | 00-00-00 | 16-01-04 | Top  | 9    | 4    |      |      | n/a       |

**Controls Summary**

|                       | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment           | 759 ft-lbs      | 11610 ft-lbs        | 6.5%              | 1    | 07-11-06 |
| End Shear             | 172 lbs         | 5785 lbs            | 3.0%              | 1    | 00-11-06 |
| Total Load Deflection | L/999 (0.098")  | n/a                 | n/a               | 4    | 07-11-06 |
| Live Load Deflection  | L/999 (0.048")  | n/a                 | n/a               | 5    | 07-11-06 |
| Max Defl.             | 0.098"          | n/a                 | n/a               | 4    | 07-11-06 |
| Span / Depth          | 19.8            |                     |                   |      |          |

| Bearing Supports | Dim. (LxW)                 | Demand  | Demand/Resistance Support | Demand/Resistance Member | Material        |
|------------------|----------------------------|---------|---------------------------|--------------------------|-----------------|
| B1               | Wall/Plate 1-7/8" x 1-3/4" | 196 lbs | 9.7%                      | 4.9%                     | Spruce-Pine-Fir |
| B2               | Wall/Plate 4-3/8" x 1-3/4" | 201 lbs | 4.3%                      | 2.1%                     | Spruce-Pine-Fir |

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO UBC 2012

AMENDED 2020

**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



DWG NO. TAW12B90-20  
**STRUCTURAL**  
**COMPONENT ONLY**



# **Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP** **2ND FLR FRAMING\Flush Beams\B17(I3303) (Flush Beam)**

**PASSED**


BC CALC® Member Report  
 Build 7493

Dry | 2 spans | L cant.

August 20, 2020 08:59:00

Job name:  
 Address:  
 City, Province, Postal Code: WATERDOWN  
 Customer:  
 Code reports: CCMC 12472-R

File name: MOUNTAINASH 5  
 Description: 2ND FLR FRAMING\Flush Beams\B17(I3303)  
 Specifier:  
 Designer: AJ  
 Company:

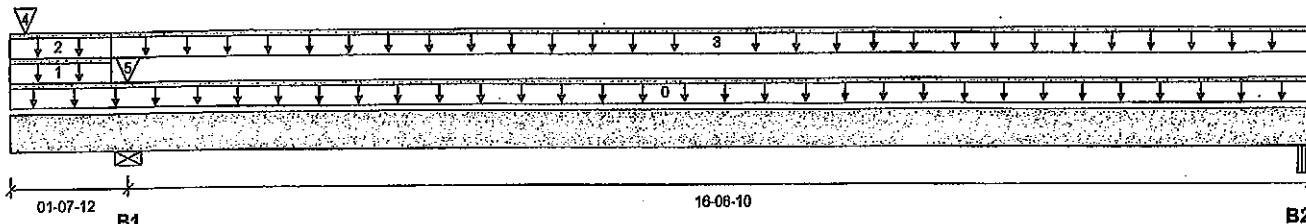

Total Horizontal Product Length = 18-02-06

## **Reaction Summary (Down / Uplift) (lbs)**

| Bearing    | Live    | Dead    | Snow   | Wind |
|------------|---------|---------|--------|------|
| B1, 5-1/2" | 364 / 0 | 445 / 0 | 48 / 0 |      |
| B2, 2-1/4" | 306 / 4 | 223 / 0 | 0 / 4  |      |

## **Load Summary**

| Tag | Description        | Load Type         | Ref. | Start    | End      | Loc. | Live<br>1.00 | Dead<br>0.65 | Snow<br>1.00 | Wind<br>1.15 | Tributary |
|-----|--------------------|-------------------|------|----------|----------|------|--------------|--------------|--------------|--------------|-----------|
| 0   | Self-Weight        | Unf. Lin. (lb/ft) | L    | 00-00-00 | 18-02-06 | Top  |              | 10           |              |              | 00-00-00  |
| 1   | E38(i2888)         | Unf. Lin. (lb/ft) | L    | 00-00-00 | 01-05-00 | Top  |              | 81           |              |              | n/a       |
| 2   | FC2 Floor Material | Unf. Lin. (lb/ft) | L    | 00-00-00 | 01-05-00 | Top  | 22           | 11           |              |              | n/a       |
| 3   | FC2 Floor Material | Unf. Lin. (lb/ft) | L    | 01-05-00 | 18-02-06 | Top  | 37           | 18           |              |              | n/a       |
| 4   | E38(i2888)         | Conc. Pt. (lbs)   | L    | 00-02-12 | 00-02-12 | Top  | 20           | 18           | 42           |              | n/a       |
| 5   | E26(i2880)         | Conc. Pt. (lbs)   | L    | 01-07-12 | 01-07-12 | Top  | 37           |              |              |              | n/a       |

## **Controls Summary**

|                       | Factored Demand    | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|--------------------|---------------------|-------------------|------|----------|
| Pos. Moment           | 2934 ft-lbs        | 23220 ft-lbs        | 12.6%             | 33   | 09-11-05 |
| Neg. Moment           | -348 ft-lbs        | -23220 ft-lbs       | 1.5%              | 37   | 01-07-12 |
| End Shear             | 650 lbs            | 11571 lbs           | 5.6%              | 33   | 17-02-10 |
| Cont. Shear           | 668 lbs            | 11571 lbs           | 5.8%              | 1    | 02-08-00 |
| Total Load Deflection | L/974 (0.202")     | n/a                 | 24.6%             | 80   | 09-11-05 |
| Live Load Deflection  | L/999 (0.12")      | n/a                 |                   | 118  | 09-09-15 |
| Total Neg. Defl.      | 2xL/1998 (-0.062") | n/a                 |                   | 80   | 00-00-00 |
| Max Defl.             | 0.202"             | n/a                 |                   | 80   | 09-11-05 |
| Span / Depth          | 20.8               |                     |                   |      |          |

| Bearing Supports | Dim. (LxW)                 | Demand   | Demand/Resistance Support | Demand/Resistance Member | Material        |
|------------------|----------------------------|----------|---------------------------|--------------------------|-----------------|
| B1               | Wall/Plate 5-1/2" x 3-1/2" | 1147 lbs | 9.7%                      | 4.9%                     | Spruce-Pine-Fir |
| B2               | Beam 2-1/4" x 3-1/2"       | 738 lbs  | 15.2%                     | 7.7%                     | Spruce-Pine-Fir |

## **Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9


Cantilevers require sheathed bottom flanges, blocking at cantilever support and closure at ends.

CONFORMS TO OBC 2012

AMENDED 2020



NO. 1212-20  
 STRUCTURAL  
 COMPONENT ONLY



**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP**  
**2ND FLR FRAMING\Flush Beams\B17(I3303) (Flush Beam)**

**PASSED**

Dry | 2 spans | L cant.

August 20, 2020 08:59:00

BC CALC® Member Report  
Build 7493

Job name:

File name: MOUNTAINASH 5

Address:

Description: 2ND FLR FRAMING\Flush Beams\B17(I3303)

City, Province, Postal Code: WATERDOWN

Specifier:


Customer:

Designer: AJ

Code reports: CCMC 12472-R

Company:

**Connection Diagram: Full Length of Member**

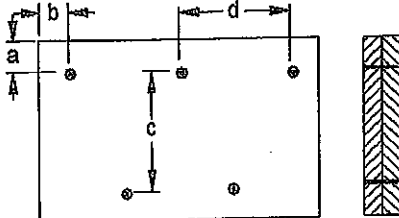

a minimum = 2"  
b minimum = 3"

c = 5-1/2"  
d = 2-1/2"

Connectors are: *1* Nails  
**3-1/2" ARDOX SPIRAL**



08/20/20

**STRUCTURAL**

**COMPONENT ONLY**

**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJST™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

# Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

## 2ND FLR FRAMING\Flush Beams\B18(i3287) (Flush Beam)


PASSED

BC CALC® Member Report  
Build 7493  
Job name:  
Address:  
City, Province, Postal Code: WATERDOWN  
Customer:  
Code reports: CCMC 12472-R

Dry | 2 spans | L cant.

August 20, 2020 08:59:00

File name: MOUNTAINASH 5  
Description: 2ND FLR FRAMING\Flush Beams\B18(i3287)  
Specifier:  
Designer: AJ  
Company:

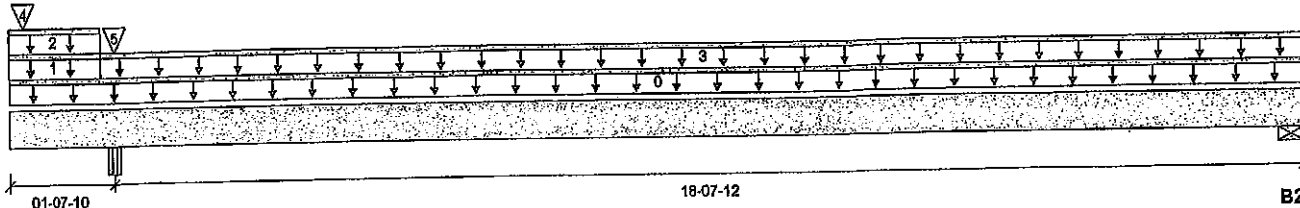

Total Horizontal Product Length = 20-03-06

### Reaction Summary (Down / Uplift) (lbs)

| Bearing    | Live    | Dead    | Snow   | Wind |
|------------|---------|---------|--------|------|
| B1, 5-1/4" | 340 / 0 | 441 / 0 | 45 / 0 |      |
| B2, 4-3/8" | 284 / 3 | 225 / 0 | 0 / 3  |      |

### Load Summary

| Tag | Description        | Load Type         | Ref. | Start    | End      | Loc. | Live | Dead | Snow | Wind | Tributary |
|-----|--------------------|-------------------|------|----------|----------|------|------|------|------|------|-----------|
| 0   | Self-Weight        | Unf. Lin. (lb/ft) | L    | 00-00-00 | 20-03-06 | Top  | 1.00 | 0.65 | 1.00 | 1.15 | 00-00-00  |
| 1   | E36(i2887)         | Unf. Lin. (lb/ft) | L    | 00-00-00 | 01-05-00 | Top  |      | 81   |      |      | n/a       |
| 2   | FC2 Floor Material | Unf. Lin. (lb/ft) | L    | 00-00-00 | 01-05-00 | Top  | 25   | 13   |      |      | n/a       |
| 3   | FC2 Floor Material | Unf. Lin. (lb/ft) | L    | 01-05-00 | 20-03-06 | Top  | 30   | 15   |      |      | n/a       |
| 4   | E36(i2887)         | Conc. Pt. (lbs)   | L    | 00-02-12 | 00-02-12 | Top  | 20   | 18   | 42   |      | n/a       |
| 5   | E22(i2883)         | Conc. Pt. (lbs)   | L    | 01-07-12 | 01-07-12 | Top  |      | 37   |      |      | n/a       |

### Controls Summary

|                       | Factored Demand    | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|--------------------|---------------------|-------------------|------|----------|
| Pos. Moment           | 3088 ft-lbs        | 23220 ft-lbs        | 13.3%             | 33   | 10-10-12 |
| Neg. Moment           | -353 ft-lbs        | -23220 ft-lbs       | 1.5%              | 1    | 01-07-10 |
| End Shear             | 619 lbs            | 11571 lbs           | 5.4%              | 33   | 19-01-08 |
| Cont. Shear           | 638 lbs            | 11571 lbs           | 5.5%              | 1    | 02-07-12 |
| Total Load Deflection | L/826 (0.267")     | n/a                 | 29.1%             | 80   | 10-10-12 |
| Live Load Deflection  | L/1440 (0.153")    | n/a                 | 25.0%             | 118  | 10-09-03 |
| Total Neg. Defl.      | 2xL/1998 (-0.073") | n/a                 | n/a               | 80   | 00-00-00 |
| Max Defl.             | 0.267"             | n/a                 | n/a               | 80   | 10-10-12 |
| Span / Depth          | 23.2               |                     |                   |      |          |

### Bearing Supports


|    | Dim. (LxW)                 | Demand   | Demand/Resistance Support | Demand/Resistance Member | Material        |
|----|----------------------------|----------|---------------------------|--------------------------|-----------------|
| B1 | Beam 5-1/4" x 3-1/2"       | 1107 lbs | 4.9%                      | 4.9%                     | VL 2.0 3100 SP  |
| B2 | Wall/Plate 4-3/8" x 3-1/2" | 707 lbs  | 7.5%                      | 3.8%                     | Spruce-Pine-Fir |

### Notes

Design meets Code minimum (L/240) Total load deflection criteria.  
Design meets Code minimum (L/360) Live load deflection criteria.  
Calculations assume member is fully braced.  
Resistance Factor phi has been applied to all presented results per CSA O86.  
BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.  
Unbalanced snow loads determined from building geometry were used in selected products verification.  
Design based on Dry Service Condition.  
Importance Factor : Normal Part code : Part 9  
Cantilevers require sheathed bottom flanges, blocking at cantilever support and closure at ends.

CONFORMS TO OBC 2012

AMENDED 2020



OWB NO. TAM/127-20  
STRUCTURAL  
COMPONENT ONLY



**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP**  
**2ND FLR FRAMING\Flush Beams\B18(I3287) (Flush Beam)**  
Dry | 2 spans | L cant.

**PASSED**

August 20, 2020 08:59:00

BC CALC® Member Report  
Build 7493

Job name:

Address:

City, Province, Postal Code: WATERDOWN

Customer:

Code reports: CCMC 12472-R.

File name: MOUNTAINASH 5


Description: 2ND FLR FRAMING\Flush Beams\B18(I3287)

Specifier:

Designer: AJ

Company:

**Connection Diagram: Full Length of Member**

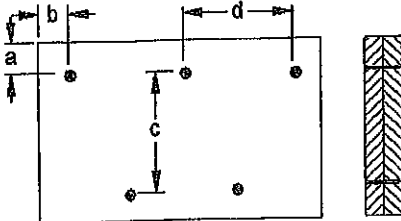

a minimum = 2"  
b minimum = 3"

c = 6-1/2"  
d = 3"

Connectors are: 1 Nails

**3-1/2" ARDOX SPIRAL**




OWN NO. YAM 12/27-20  
**STRUCTURAL  
COMPONENT ONLY**

**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before Installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



## Maximum Floor Spans


Live Load = 40 psf, Dead Load = 30 psf  
Simple Spans, L/480 Deflection Limit  
3/4" OSB G&N Sheathing

| Depth   | Series | Bare              |         |         |         | 1/2" Gypsum Ceiling |         |         |         |
|---------|--------|-------------------|---------|---------|---------|---------------------|---------|---------|---------|
|         |        | On Centre Spacing |         |         |         | On Centre Spacing   |         |         |         |
|         |        | 12"               | 16"     | 19.2"   | 24"     | 12"                 | 16"     | 19.2"   | 24"     |
| 9-1/2"  | NI-20  | 15'-7"            | 14'-2"  | 13'-4"  | 12'-4"  | 15'-7"              | 14'-2"  | 13'-4"  | 12'-4"  |
|         | NI-40x | 17'-0"            | 16'-0"  | 15'-1"  | 13'-11" | 17'-5"              | 16'-1"  | 15'-1"  | 13'-11" |
|         | NI-60  | 17'-2"            | 16'-2"  | 15'-5"  | 14'-3"  | 17'-6"              | 16'-5"  | 15'-5"  | 14'-3"  |
|         | NI-70  | 18'-0"            | 16'-11" | 16'-3"  | 15'-6"  | 18'-5"              | 17'-3"  | 16'-7"  | 15'-6"  |
|         | NI-80  | 18'-3"            | 17'-1"  | 16'-5"  | 15'-9"  | 18'-8"              | 17'-5"  | 16'-9"  | 15'-10" |
| 11-7/8" | NI-20  | 17'-10"           | 16'-10" | 16'-0"  | 14'-10" | 18'-6"              | 17'-1"  | 16'-0"  | 14'-10" |
|         | NI-40x | 19'-4"            | 17'-11" | 17'-3"  | 15'-10" | 19'-11"             | 18'-6"  | 17'-9"  | 15'-10" |
|         | NI-60  | 19'-7"            | 18'-2"  | 17'-5"  | 16'-9"  | 20'-2"              | 18'-9"  | 17'-11" | 17'-1"  |
|         | NI-70  | 20'-9"            | 19'-2"  | 18'-3"  | 17'-5"  | 21'-4"              | 19'-9"  | 18'-10" | 17'-10" |
|         | NI-80  | 21'-1"            | 19'-5"  | 18'-6"  | 17'-7"  | 21'-7"              | 20'-0"  | 19'-0"  | 18'-0"  |
| 14"     | NI-90x | 21'-8"            | 20'-0"  | 19'-1"  | 18'-0"  | 22'-2"              | 20'-6"  | 19'-6"  | 18'-6"  |
|         | NI-40x | 21'-5"            | 19'-10" | 18'-11" | 17'-5"  | 22'-1"              | 20'-6"  | 19'-6"  | 17'-5"  |
|         | NI-60  | 21'-10"           | 20'-2"  | 19'-3"  | 18'-2"  | 22'-5"              | 20'-10" | 19'-11" | 18'-10" |
|         | NI-70  | 23'-0"            | 21'-3"  | 20'-3"  | 19'-2"  | 23'-8"              | 21'-11" | 20'-10" | 19'-9"  |
|         | NI-80  | 23'-5"            | 21'-7"  | 20'-7"  | 19'-5"  | 24'-0"              | 22'-3"  | 21'-2"  | 20'-0"  |
| 16"     | NI-90x | 24'-1"            | 22'-3"  | 21'-2"  | 20'-0"  | 24'-8"              | 22'-10" | 21'-9"  | 20'-7"  |
|         | NI-60  | 23'-9"            | 22'-0"  | 20'-11" | 19'-10" | 24'-6"              | 22'-9"  | 21'-8"  | 20'-6"  |
|         | NI-70  | 25'-1"            | 23'-2"  | 22'-0"  | 20'-10" | 25'-9"              | 23'-10" | 22'-9"  | 21'-6"  |
|         | NI-80  | 25'-6"            | 23'-6"  | 22'-4"  | 21'-2"  | 26'-1"              | 24'-2"  | 23'-1"  | 21'-10" |
|         | NI-90x | 26'-4"            | 24'-3"  | 23'-1"  | 21'-10" | 26'-11"             | 24'-11" | 23'-8"  | 22'-5"  |

| Depth   | Series | Mid-Span Blocking |         |        |         | Mid-Span Blocking and 1/2" Gypsum Ceiling |         |         |         |
|---------|--------|-------------------|---------|--------|---------|-------------------------------------------|---------|---------|---------|
|         |        | On Centre Spacing |         |        |         | On Centre Spacing                         |         |         |         |
|         |        | 12"               | 16"     | 19.2"  | 24"     | 12"                                       | 16"     | 19.2"   | 24"     |
| 9-1/2"  | NI-20  | 15'-7"            | 14'-2"  | 13'-4" | 12'-4"  | 15'-7"                                    | 14'-2"  | 13'-4"  | 12'-4"  |
|         | NI-40x | 17'-9"            | 16'-1"  | 15'-1" | 13'-11" | 17'-9"                                    | 16'-1"  | 15'-1"  | 13'-11" |
|         | NI-60  | 18'-1"            | 16'-5"  | 15'-5" | 14'-3"  | 18'-1"                                    | 16'-5"  | 15'-5"  | 14'-3"  |
|         | NI-70  | 19'-10"           | 17'-11" | 16'-9" | 15'-6"  | 19'-10"                                   | 17'-11" | 16'-9"  | 15'-6"  |
|         | NI-80  | 20'-2"            | 18'-3"  | 17'-1" | 15'-10" | 20'-2"                                    | 18'-3"  | 17'-1"  | 15'-10" |
| 11-7/8" | NI-20  | 18'-10"           | 17'-1"  | 16'-0" | 14'-10" | 18'-10"                                   | 17'-1"  | 16'-0"  | 14'-10" |
|         | NI-40x | 21'-3"            | 19'-3"  | 17'-9" | 15'-10" | 21'-3"                                    | 19'-3"  | 17'-9"  | 15'-10" |
|         | NI-60  | 21'-9"            | 19'-8"  | 18'-5" | 17'-1"  | 21'-9"                                    | 19'-8"  | 18'-5"  | 17'-1"  |
|         | NI-70  | 23'-4"            | 21'-5"  | 20'-1" | 18'-6"  | 23'-8"                                    | 21'-5"  | 20'-1"  | 18'-6"  |
|         | NI-80  | 23'-7"            | 21'-10" | 20'-5" | 18'-11" | 24'-1"                                    | 21'-10" | 20'-5"  | 18'-11" |
| 14"     | NI-90x | 24'-3"            | 22'-6"  | 21'-3" | 19'-7"  | 24'-8"                                    | 22'-7"  | 21'-3"  | 19'-7"  |
|         | NI-40x | 24'-2"            | 21'-5"  | 19'-6" | 17'-5"  | 24'-2"                                    | 21'-5"  | 19'-6"  | 17'-5"  |
|         | NI-60  | 24'-9"            | 22'-5"  | 21'-0" | 19'-6"  | 24'-9"                                    | 22'-5"  | 21'-0"  | 19'-6"  |
|         | NI-70  | 26'-1"            | 24'-3"  | 22'-9" | 21'-0"  | 26'-8"                                    | 24'-3"  | 22'-9"  | 21'-0"  |
|         | NI-80  | 26'-6"            | 24'-7"  | 23'-3" | 21'-6"  | 27'-1"                                    | 24'-10" | 23'-3"  | 21'-6"  |
| 16"     | NI-90x | 27'-3"            | 25'-4"  | 24'-1" | 22'-4"  | 27'-9"                                    | 25'-10" | 24'-3"  | 22'-4"  |
|         | NI-60  | 27'-3"            | 24'-11" | 23'-5" | 21'-7"  | 27'-6"                                    | 24'-11" | 23'-5"  | 21'-7"  |
|         | NI-70  | 28'-8"            | 26'-8"  | 25'-3" | 23'-4"  | 29'-3"                                    | 26'-11" | 25'-3"  | 23'-4"  |
|         | NI-80  | 29'-1"            | 27'-0"  | 25'-9" | 23'-10" | 29'-8"                                    | 27'-6"  | 25'-10" | 23'-10" |
|         | NI-90x | 29'-11"           | 27'-10" | 26'-6" | 24'-10" | 30'-6"                                    | 28'-5"  | 26'-11" | 24'-10" |

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.



## Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf  
Simple Spans, L/480 Deflection Limit  
5/8" OSB G&N Sheathing

| Depth   | Series | Bare              |         |         |     | 1/2" Gypsum Ceiling |         |         |     |
|---------|--------|-------------------|---------|---------|-----|---------------------|---------|---------|-----|
|         |        | On Centre Spacing |         |         |     | On Centre Spacing   |         |         |     |
|         |        | 12"               | 16"     | 19.2"   | 24" | 12"                 | 16"     | 19.2"   | 24" |
| 9-1/2"  | NI-20  | 15'-1"            | 14'-2"  | 13'-9"  | N/A | 15'-7"              | 14'-8"  | 14'-2"  | N/A |
|         | NI-40x | 16'-1"            | 15'-2"  | 14'-8"  | N/A | 16'-7"              | 15'-7"  | 15'-1"  | N/A |
|         | NI-60  | 16'-3"            | 15'-4"  | 14'-10" | N/A | 16'-8"              | 15'-9"  | 15'-3"  | N/A |
|         | NI-70  | 17'-1"            | 16'-1"  | 15'-6"  | N/A | 17'-5"              | 16'-5"  | 15'-10" | N/A |
|         | NI-80  | 17'-3"            | 16'-3"  | 15'-8"  | N/A | 17'-8"              | 16'-7"  | 16'-0"  | N/A |
| 11-7/8" | NI-20  | 16'-11"           | 16'-0"  | 15'-5"  | N/A | 17'-6"              | 16'-6"  | 16'-0"  | N/A |
|         | NI-40x | 18'-1"            | 17'-0"  | 16'-5"  | N/A | 18'-9"              | 17'-6"  | 16'-11" | N/A |
|         | NI-60  | 18'-4"            | 17'-3"  | 16'-7"  | N/A | 19'-0"              | 17'-8"  | 17'-1"  | N/A |
|         | NI-70  | 19'-6"            | 18'-0"  | 17'-4"  | N/A | 20'-1"              | 18'-7"  | 17'-9"  | N/A |
|         | NI-80  | 19'-9"            | 18'-3"  | 17'-6"  | N/A | 20'-4"              | 18'-10" | 17'-11" | N/A |
| 14"     | NI-90x | 20'-4"            | 18'-9"  | 17'-11" | N/A | 20'-10"             | 19'-3"  | 18'-5"  | N/A |
|         | NI-40x | 20'-1"            | 18'-7"  | 17'-10" | N/A | 20'-10"             | 19'-4"  | 18'-6"  | N/A |
|         | NI-60  | 20'-5"            | 18'-11" | 18'-1"  | N/A | 21'-2"              | 19'-7"  | 18'-9"  | N/A |
|         | NI-70  | 21'-7"            | 20'-0"  | 19'-1"  | N/A | 22'-3"              | 20'-7"  | 19'-8"  | N/A |
|         | NI-80  | 21'-11"           | 20'-3"  | 19'-4"  | N/A | 22'-7"              | 20'-11" | 20'-0"  | N/A |
| 16"     | NI-90x | 22'-7"            | 20'-11" | 19'-11" | N/A | 23'-3"              | 21'-6"  | 20'-6"  | N/A |
|         | NI-60  | 22'-3"            | 20'-8"  | 19'-9"  | N/A | 23'-1"              | 21'-5"  | 20'-6"  | N/A |
|         | NI-70  | 23'-5"            | 21'-9"  | 20'-9"  | N/A | 24'-3"              | 22'-5"  | 21'-5"  | N/A |
|         | NI-80  | 23'-11"           | 22'-1"  | 21'-1"  | N/A | 24'-8"              | 22'-10" | 21'-9"  | N/A |
|         | NI-90x | 24'-8"            | 22'-9"  | 21'-9"  | N/A | 25'-4"              | 23'-5"  | 22'-4"  | N/A |

| Depth   | Series | Mid-Span Blocking |         |         |     | Mid-Span Blocking and 1/2" Gypsum Ceiling |         |         |     |
|---------|--------|-------------------|---------|---------|-----|-------------------------------------------|---------|---------|-----|
|         |        | On Centre Spacing |         |         |     | On Centre Spacing                         |         |         |     |
|         |        | 12"               | 16"     | 19.2"   | 24" | 12"                                       | 16"     | 19.2"   | 24" |
| 9-1/2"  | NI-20  | 16'-8"            | 15'-3"  | 14'-5"  | N/A | 16'-8"                                    | 15'-3"  | 14'-5"  | N/A |
|         | NI-40x | 17'-11"           | 16'-11" | 16'-1"  | N/A | 18'-5"                                    | 17'-1"  | 16'-1"  | N/A |
|         | NI-60  | 18'-2"            | 17'-1"  | 16'-4"  | N/A | 18'-7"                                    | 17'-4"  | 16'-4"  | N/A |
|         | NI-70  | 19'-2"            | 17'-10" | 17'-2"  | N/A | 19'-7"                                    | 18'-3"  | 17'-7"  | N/A |
|         | NI-80  | 19'-5"            | 18'-0"  | 17'-4"  | N/A | 19'-10"                                   | 18'-5"  | 17'-8"  | N/A |
| 11-7/8" | NI-20  | 19'-6"            | 18'-1"  | 17'-3"  | N/A | 19'-11"                                   | 18'-3"  | 17'-3"  | N/A |
|         | NI-40x | 21'-0"            | 19'-6"  | 18'-8"  | N/A | 21'-7"                                    | 20'-2"  | 19'-2"  | N/A |
|         | NI-60  | 21'-4"            | 19'-9"  | 18'-11" | N/A | 21'-11"                                   | 20'-4"  | 19'-6"  | N/A |
|         | NI-70  | 22'-6"            | 20'-10" | 19'-11" | N/A | 23'-0"                                    | 21'-5"  | 20'-5"  | N/A |
|         | NI-80  | 22'-9"            | 21'-1"  | 20'-1"  | N/A | 23'-3"                                    | 21'-7"  | 20'-8"  | N/A |
| 14"     | NI-90x | 23'-4"            | 21'-8"  | 20'-8"  | N/A | 23'-10"                                   | 22'-2"  | 21'-2"  | N/A |
|         | NI-40x | 23'-7"            | 21'-11" | 20'-11" | N/A | 24'-3"                                    | 22'-7"  | 21'-7"  | N/A |
|         | NI-60  | 24'-0"            | 22'-3"  | 21'-3"  | N/A | 24'-8"                                    | 22'-11" | 21'-11" | N/A |
|         | NI-70  | 25'-3"            | 23'-4"  | 22'-3"  | N/A | 25'-10"                                   | 24'-0"  | 22'-11" | N/A |
|         | NI-80  | 25'-7"            | 23'-8"  | 22'-7"  | N/A | 26'-2"                                    | 24'-4"  | 23'-2"  | N/A |
| 16"     | NI-90x | 26'-4"            | 24'-4"  | 23'-3"  | N/A | 26'-10"                                   | 24'-11" | 23'-9"  | N/A |
|         | NI-60  | 26'-5"            | 24'-6"  | 23'-4"  | N/A | 27'-2"                                    | 25'-3"  | 24'-2"  | N/A |
|         | NI-70  | 27'-9"            | 25'-8"  | 24'-6"  | N/A | 28'-5"                                    | 26'-5"  | 25'-2"  | N/A |
|         | NI-80  | 28'-2"            | 26'-1"  | 24'-10" | N/A | 28'-10"                                   | 26'-9"  | 25'-6"  | N/A |
|         | NI-90x | 29'-0"            | 26'-10" | 25'-7"  | N/A | 29'-7"                                    | 27'-5"  | 26'-2"  | N/A |

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.



## Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf  
Simple Spans, L/480 Deflection Limit  
3/4" OSB G&N Sheathing

| Depth   | Series | Bare              |         |         |         | 1/2" Gypsum Ceiling |         |         |         |
|---------|--------|-------------------|---------|---------|---------|---------------------|---------|---------|---------|
|         |        | On Centre Spacing |         |         |         | On Centre Spacing   |         |         |         |
|         |        | 12"               | 16"     | 19.2"   | 24"     | 12"                 | 16"     | 19.2"   | 24"     |
| 9-1/2"  | NI-20  | 15'-10"           | 15'-0"  | 14'-5"  | 13'-5"  | 16'-4"              | 15'-5"  | 14'-6"  | 13'-5"  |
|         | NI-40x | 17'-0"            | 16'-0"  | 15'-5"  | 14'-9"  | 17'-5"              | 16'-5"  | 15'-10" | 15'-2"  |
|         | NI-60  | 17'-2"            | 16'-2"  | 15'-7"  | 14'-11" | 17'-6"              | 16'-7"  | 15'-11" | 15'-3"  |
|         | NI-70  | 18'-0"            | 16'-11" | 16'-3"  | 15'-7"  | 18'-5"              | 17'-3"  | 16'-7"  | 15'-11" |
|         | NI-80  | 18'-3"            | 17'-1"  | 16'-5"  | 15'-9"  | 18'-8"              | 17'-5"  | 16'-9"  | 16'-1"  |
| 11-7/8" | NI-20  | 17'-10"           | 16'-10" | 16'-2"  | 15'-6"  | 18'-6"              | 17'-4"  | 16'-9"  | 16'-1"  |
|         | NI-40x | 19'-4"            | 17'-11" | 17'-3"  | 16'-6"  | 19'-11"             | 18'-6"  | 17'-9"  | 17'-0"  |
|         | NI-60  | 19'-7"            | 18'-2"  | 17'-5"  | 16'-9"  | 20'-2"              | 18'-9"  | 17'-11" | 17'-2"  |
|         | NI-70  | 20'-9"            | 19'-2"  | 18'-3"  | 17'-5"  | 21'-4"              | 19'-9"  | 18'-10" | 17'-10" |
|         | NI-80  | 21'-1"            | 19'-5"  | 18'-6"  | 17'-7"  | 21'-7"              | 20'-0"  | 19'-0"  | 18'-0"  |
| 14"     | NI-90x | 21'-8"            | 20'-0"  | 19'-1"  | 18'-0"  | 22'-2"              | 20'-6"  | 19'-6"  | 18'-6"  |
|         | NI-40x | 21'-5"            | 19'-10" | 18'-11" | 17'-11" | 22'-1"              | 20'-6"  | 19'-7"  | 18'-7"  |
|         | NI-60  | 21'-10"           | 20'-2"  | 19'-3"  | 18'-2"  | 22'-5"              | 20'-10" | 19'-11" | 18'-10" |
|         | NI-70  | 23'-0"            | 21'-3"  | 20'-3"  | 19'-2"  | 23'-8"              | 21'-11" | 20'-10" | 19'-9"  |
|         | NI-80  | 23'-5"            | 21'-7"  | 20'-7"  | 19'-5"  | 24'-0"              | 22'-3"  | 21'-2"  | 20'-0"  |
| 16"     | NI-90x | 24'-1"            | 22'-3"  | 21'-2"  | 20'-0"  | 24'-8"              | 22'-10" | 21'-9"  | 20'-7"  |
|         | NI-60  | 23'-9"            | 22'-0"  | 20'-11" | 19'-10" | 24'-6"              | 22'-9"  | 21'-8"  | 20'-6"  |
|         | NI-70  | 25'-1"            | 23'-2"  | 22'-0"  | 20'-10" | 25'-9"              | 23'-10" | 22'-9"  | 21'-6"  |
|         | NI-80  | 25'-6"            | 23'-6"  | 22'-4"  | 21'-2"  | 26'-1"              | 24'-2"  | 23'-1"  | 21'-10" |
|         | NI-90x | 26'-4"            | 24'-3"  | 23'-1"  | 21'-10" | 26'-11"             | 24'-11" | 23'-8"  | 22'-5"  |


| Depth   | Series | Mid-Span Blocking |         |         |         | Mid-Span Blocking and 1/2" Gypsum Ceiling |         |         |         |
|---------|--------|-------------------|---------|---------|---------|-------------------------------------------|---------|---------|---------|
|         |        | On Centre Spacing |         |         |         | On Centre Spacing                         |         |         |         |
|         |        | 12"               | 16"     | 19.2"   | 24"     | 12"                                       | 16"     | 19.2"   | 24"     |
| 9-1/2"  | NI-20  | 16'-10"           | 15'-5"  | 14'-6"  | 13'-5"  | 16'-10"                                   | 15'-5"  | 14'-6"  | 13'-5"  |
|         | NI-40x | 18'-8"            | 17'-2"  | 16'-3"  | 15'-2"  | 18'-10"                                   | 17'-2"  | 16'-3"  | 15'-2"  |
|         | NI-60  | 18'-11"           | 17'-6"  | 16'-6"  | 15'-5"  | 19'-2"                                    | 17'-6"  | 16'-6"  | 15'-5"  |
|         | NI-70  | 20'-0"            | 18'-7"  | 17'-9"  | 16'-7"  | 20'-5"                                    | 18'-11" | 17'-10" | 16'-7"  |
|         | NI-80  | 20'-3"            | 18'-10" | 17'-11" | 16'-10" | 20'-8"                                    | 19'-3"  | 18'-2"  | 16'-10" |
| 11-7/8" | NI-20  | 20'-1"            | 18'-5"  | 17'-5"  | 16'-2"  | 20'-1"                                    | 18'-5"  | 17'-5"  | 16'-2"  |
|         | NI-40x | 21'-10"           | 20'-4"  | 19'-4"  | 17'-8"  | 22'-5"                                    | 20'-6"  | 19'-4"  | 17'-8"  |
|         | NI-60  | 22'-1"            | 20'-7"  | 19'-7"  | 18'-4"  | 22'-8"                                    | 20'-10" | 19'-8"  | 18'-4"  |
|         | NI-70  | 23'-4"            | 21'-8"  | 20'-8"  | 19'-7"  | 23'-10"                                   | 22'-3"  | 21'-2"  | 19'-9"  |
|         | NI-80  | 23'-7"            | 21'-11" | 20'-11" | 19'-9"  | 24'-1"                                    | 22'-6"  | 21'-5"  | 20'-0"  |
| 14"     | NI-90x | 24'-3"            | 22'-6"  | 21'-6"  | 20'-4"  | 24'-8"                                    | 23'-0"  | 22'-0"  | 20'-9"  |
|         | NI-40x | 24'-5"            | 22'-9"  | 21'-8"  | 19'-5"  | 25'-1"                                    | 23'-2"  | 21'-9"  | 19'-5"  |
|         | NI-60  | 24'-10"           | 23'-1"  | 22'-0"  | 20'-10" | 25'-6"                                    | 23'-8"  | 22'-4"  | 20'-10" |
|         | NI-70  | 26'-1"            | 24'-3"  | 23'-2"  | 21'-10" | 26'-8"                                    | 24'-11" | 23'-9"  | 22'-4"  |
|         | NI-80  | 26'-6"            | 24'-7"  | 23'-5"  | 22'-2"  | 27'-1"                                    | 25'-3"  | 24'-1"  | 22'-9"  |
| 16"     | NI-90x | 27'-3"            | 25'-4"  | 24'-1"  | 22'-9"  | 27'-9"                                    | 25'-11" | 24'-8"  | 23'-4"  |
|         | NI-60  | 27'-3"            | 25'-5"  | 24'-2"  | 22'-10" | 28'-0"                                    | 26'-2"  | 24'-9"  | 23'-1"  |
|         | NI-70  | 28'-8"            | 26'-8"  | 25'-4"  | 23'-11" | 29'-3"                                    | 27'-4"  | 26'-1"  | 24'-8"  |
|         | NI-80  | 29'-1"            | 27'-0"  | 25'-9"  | 24'-4"  | 29'-8"                                    | 27'-9"  | 26'-5"  | 25'-0"  |
|         | NI-90x | 29'-11"           | 27'-10" | 26'-6"  | 25'-0"  | 30'-6"                                    | 28'-5"  | 27'-2"  | 25'-8"  |

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-1274C.



## Maximum Floor Spans

Live Load = 40 psf, Dead Load = 30 psf  
Simple Spans, L/480 Deflection Limit  
5/8" OSB G&N Sheathing





| Depth   | Series | Bare              |         |         |     | 1/2" Gypsum Ceiling |         |         |     |
|---------|--------|-------------------|---------|---------|-----|---------------------|---------|---------|-----|
|         |        | On Centre Spacing |         |         |     | On Centre Spacing   |         |         |     |
|         |        | 12"               | 16"     | 19.2"   | 24" | 12"                 | 16"     | 19.2"   | 24" |
| 9-1/2"  | NI-20  | 15'-1"            | 14'-1"  | 13'-3"  | N/A | 15'-7"              | 14'-1"  | 13'-3"  | N/A |
|         | NI-40x | 16'-1"            | 15'-2"  | 14'-8"  | N/A | 16'-7"              | 15'-7"  | 15'-1"  | N/A |
|         | NI-60  | 16'-3"            | 15'-4"  | 14'-10" | N/A | 16'-8"              | 15'-9"  | 15'-3"  | N/A |
|         | NI-70  | 17'-1"            | 16'-1"  | 15'-6"  | N/A | 17'-5"              | 16'-5"  | 15'-10" | N/A |
|         | NI-80  | 17'-3"            | 16'-3"  | 15'-8"  | N/A | 17'-8"              | 16'-7"  | 16'-0"  | N/A |
| 11-7/8" | NI-20  | 16'-11"           | 16'-0"  | 15'-5"  | N/A | 17'-6"              | 16'-6"  | 16'-0"  | N/A |
|         | NI-40x | 18'-1"            | 17'-0"  | 16'-5"  | N/A | 18'-9"              | 17'-6"  | 16'-11" | N/A |
|         | NI-60  | 18'-4"            | 17'-3"  | 16'-7"  | N/A | 19'-0"              | 17'-8"  | 17'-1"  | N/A |
|         | NI-70  | 19'-6"            | 18'-0"  | 17'-4"  | N/A | 20'-1"              | 18'-7"  | 17'-9"  | N/A |
|         | NI-80  | 19'-9"            | 18'-3"  | 17'-6"  | N/A | 20'-4"              | 18'-10" | 17'-11" | N/A |
| 14"     | NI-90x | 20'-4"            | 18'-9"  | 17'-11" | N/A | 20'-10"             | 19'-3"  | 18'-5"  | N/A |
|         | NI-40x | 20'-1"            | 18'-7"  | 17'-10" | N/A | 20'-10"             | 19'-4"  | 18'-6"  | N/A |
|         | NI-60  | 20'-5"            | 18'-11" | 18'-1"  | N/A | 21'-2"              | 19'-7"  | 18'-9"  | N/A |
|         | NI-70  | 21'-7"            | 20'-0"  | 19'-1"  | N/A | 22'-3"              | 20'-7"  | 19'-8"  | N/A |
|         | NI-80  | 21'-11"           | 20'-3"  | 19'-4"  | N/A | 22'-7"              | 20'-11" | 20'-0"  | N/A |
| 16"     | NI-90x | 22'-7"            | 20'-11" | 19'-11" | N/A | 23'-3"              | 21'-6"  | 20'-6"  | N/A |
|         | NI-60  | 22'-3"            | 20'-8"  | 19'-9"  | N/A | 23'-1"              | 21'-5"  | 20'-6"  | N/A |
|         | NI-70  | 23'-6"            | 21'-9"  | 20'-9"  | N/A | 24'-3"              | 22'-5"  | 21'-5"  | N/A |
|         | NI-80  | 23'-11"           | 22'-1"  | 21'-1"  | N/A | 24'-8"              | 22'-10" | 21'-9"  | N/A |
|         | NI-90x | 24'-8"            | 22'-9"  | 21'-9"  | N/A | 25'-4"              | 23'-5"  | 22'-4"  | N/A |

| Depth   | Series | Mid-Span Blocking |         |         |     | Mid-Span Blocking and 1/2" Gypsum Ceiling |         |        |     |
|---------|--------|-------------------|---------|---------|-----|-------------------------------------------|---------|--------|-----|
|         |        | On Centre Spacing |         |         |     | On Centre Spacing                         |         |        |     |
|         |        | 12"               | 16"     | 19.2"   | 24" | 12"                                       | 16"     | 19.2"  | 24" |
| 9-1/2"  | NI-20  | 15'-7"            | 14'-1"  | 13'-3"  | N/A | 15'-7"                                    | 14'-1"  | 13'-3" | N/A |
|         | NI-40x | 17'-9"            | 16'-1"  | 15'-1"  | N/A | 17'-9"                                    | 16'-1"  | 15'-1" | N/A |
|         | NI-60  | 18'-1"            | 16'-4"  | 15'-4"  | N/A | 18'-1"                                    | 16'-4"  | 15'-4" | N/A |
|         | NI-70  | 19'-2"            | 17'-10" | 16'-9"  | N/A | 19'-7"                                    | 17'-10" | 16'-9" | N/A |
|         | NI-80  | 19'-5"            | 18'-0"  | 17'-1"  | N/A | 19'-10"                                   | 18'-3"  | 17'-1" | N/A |
| 11-7/8" | NI-20  | 18'-9"            | 17'-0"  | 16'-0"  | N/A | 18'-9"                                    | 17'-0"  | 16'-0" | N/A |
|         | NI-40x | 21'-0"            | 19'-3"  | 17'-9"  | N/A | 21'-3"                                    | 19'-3"  | 17'-9" | N/A |
|         | NI-60  | 21'-4"            | 19'-8"  | 18'-5"  | N/A | 21'-8"                                    | 19'-8"  | 18'-5" | N/A |
|         | NI-70  | 22'-6"            | 20'-10" | 19'-11" | N/A | 23'-0"                                    | 21'-4"  | 20'-0" | N/A |
|         | NI-80  | 22'-9"            | 21'-1"  | 20'-1"  | N/A | 23'-3"                                    | 21'-7"  | 20'-5" | N/A |
| 14"     | NI-90x | 23'-4"            | 21'-8"  | 20'-8"  | N/A | 23'-10"                                   | 22'-2"  | 21'-2" | N/A |
|         | NI-40x | 23'-7"            | 21'-5"  | 19'-6"  | N/A | 24'-1"                                    | 21'-5"  | 19'-6" | N/A |
|         | NI-60  | 24'-0"            | 22'-3"  | 21'-0"  | N/A | 24'-8"                                    | 22'-5"  | 21'-0" | N/A |
|         | NI-70  | 25'-3"            | 23'-4"  | 22'-3"  | N/A | 25'-10"                                   | 24'-0"  | 22'-9" | N/A |
|         | NI-80  | 25'-7"            | 23'-8"  | 22'-7"  | N/A | 26'-2"                                    | 24'-4"  | 23'-2" | N/A |
| 16"     | NI-90x | 26'-4"            | 24'-4"  | 23'-3"  | N/A | 26'-10"                                   | 24'-11" | 23'-9" | N/A |
|         | NI-60  | 26'-5"            | 24'-6"  | 23'-4"  | N/A | 27'-2"                                    | 24'-10" | 23'-4" | N/A |
|         | NI-70  | 27'-9"            | 25'-8"  | 24'-6"  | N/A | 28'-5"                                    | 26'-5"  | 25'-2" | N/A |
|         | NI-80  | 28'-2"            | 26'-1"  | 24'-10" | N/A | 28'-10"                                   | 26'-9"  | 25'-6" | N/A |
|         | NI-90x | 29'-0"            | 26'-10" | 25'-7"  | N/A | 29'-7"                                    | 27'-5"  | 26'-2" | N/A |

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-1274C.

1w-1

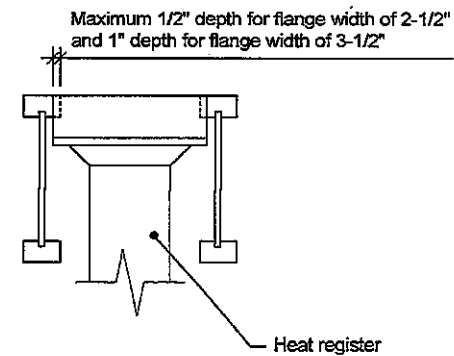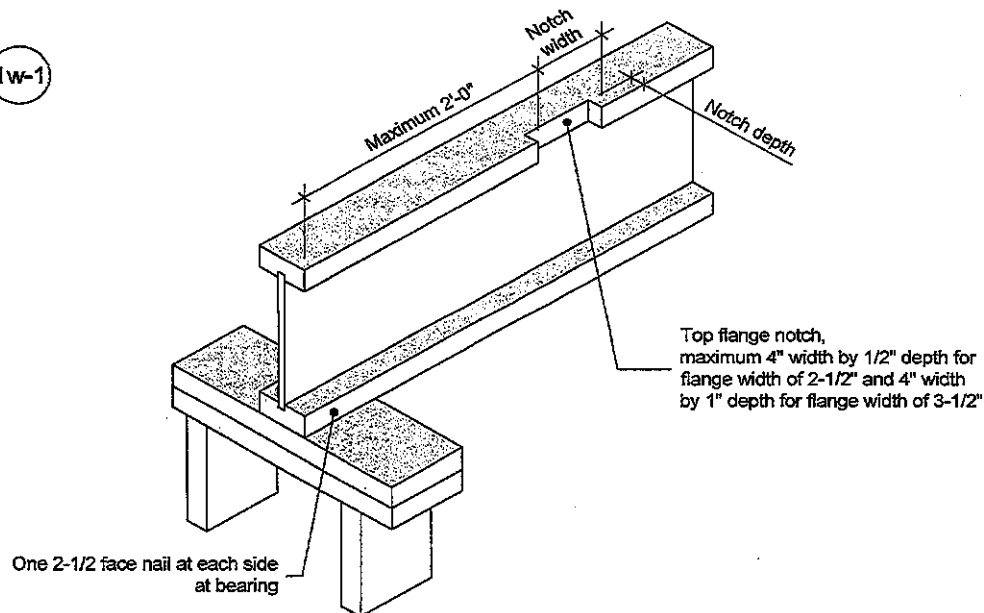

**Notes:**

1. Blocking required at bearing for lateral support, not shown for clarity.
2. The maximum dimensions for a notch on the side of the top flange are 4-inch width by 1/2-inch depth for flange width of 2-1/2 inches, and 4-inch width by 1-inch depth for flange width of 3-1/2 inches.
3. This detail applies to simple-span joists and multiple-span joists where the notch is located at the end half-span.
4. For other applications, contact Nordic Structures.

This document supersedes all previous versions. If the document has been in effect for more than one year, consult [nordic.ca](http://nordic.ca) or contact Nordic Structures.

All nails shown in the details are assumed to be common nails unless otherwise noted. Nails shall have a diameter not less than 0.128 inch for 2-1/2-inch nails, or 0.144 inch for 3-inch nails. Individual components not shown to scale for clarity.

**NORDIC  
STRUCTURES**

T 514-871-8526  
1 866 817-3418  
[nordic.ca](http://nordic.ca)

**TITLE**

Notch in I-joist for Heat Register

**CATEGORY**

I-joist - Typical Floor Framing and Construction Details

**DOCUMENT**

-

**DATE**

2018-04-10

**NUMBER**


1w-1

## Allowance for Piping (Installation Notes)

The floor layouts have usually not been checked for heating and/or plumbing interference. On-site adjustment of joists of up to 3 inches is permitted to avoid interferences. When moving a joist, the subfloor thickness shall be checked with code requirements when the joist spacing exceeds 19.2 inches. Except for cutting to length, I-joist flanges should never be cut, drilled, or notched.

Installation of Nordic I-joists shall be as per *Nordic Joist Installation Guide for Residential Floors*. Refer to Tables 1 and 2 for maximum web hole and duct chase openings, respectively. These tables are based on the I-joists being used at their maximum spans. The minimum distance given may be reduced for shorter spans; contact your distributor for additional information.

The detail below shows the 3-inch allowance for piping. Every third joist may be shifted up to 3 inches to avoid heating/plumbing interference. For other applications, please contact your distributor.

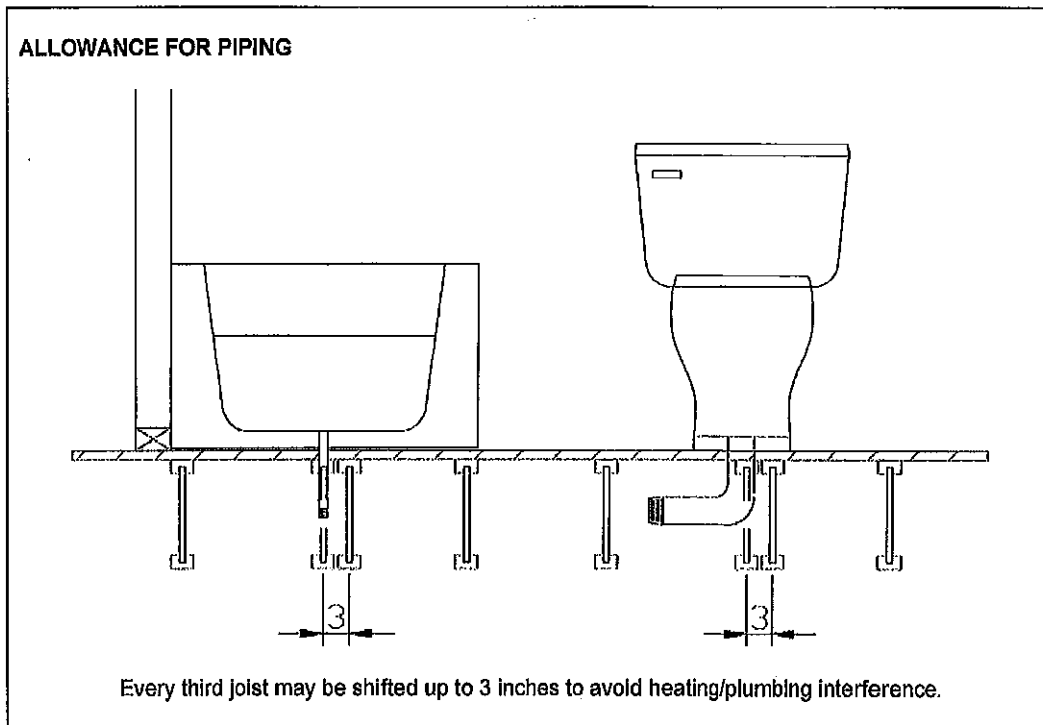

Revised April 12, 2012