

FROM PLAN DATED: AUG 28, 2020

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS PH 3

MODEL: MOUNTAINASH 5

ELEVATION: 2

LOT: 335

CITY: WATERDOWN

SALESMAN: MARIO DICIANO

DESIGNER: AJ

REVISION: L.D.

NOTES:

REFER TO THE **NORDIC INSTALLATION GUIDE** FOR PROPER STORAGE AND INSTALLATION.

SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7, TABLES 1 & 2. **CERAMIC TILE** APPLICATION AS PER O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000


LIVE LOAD: 40.0 lb/ft²

DEAD LOAD: 20.0 lb/ft²

SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 2020-09-16


1st FLOOR

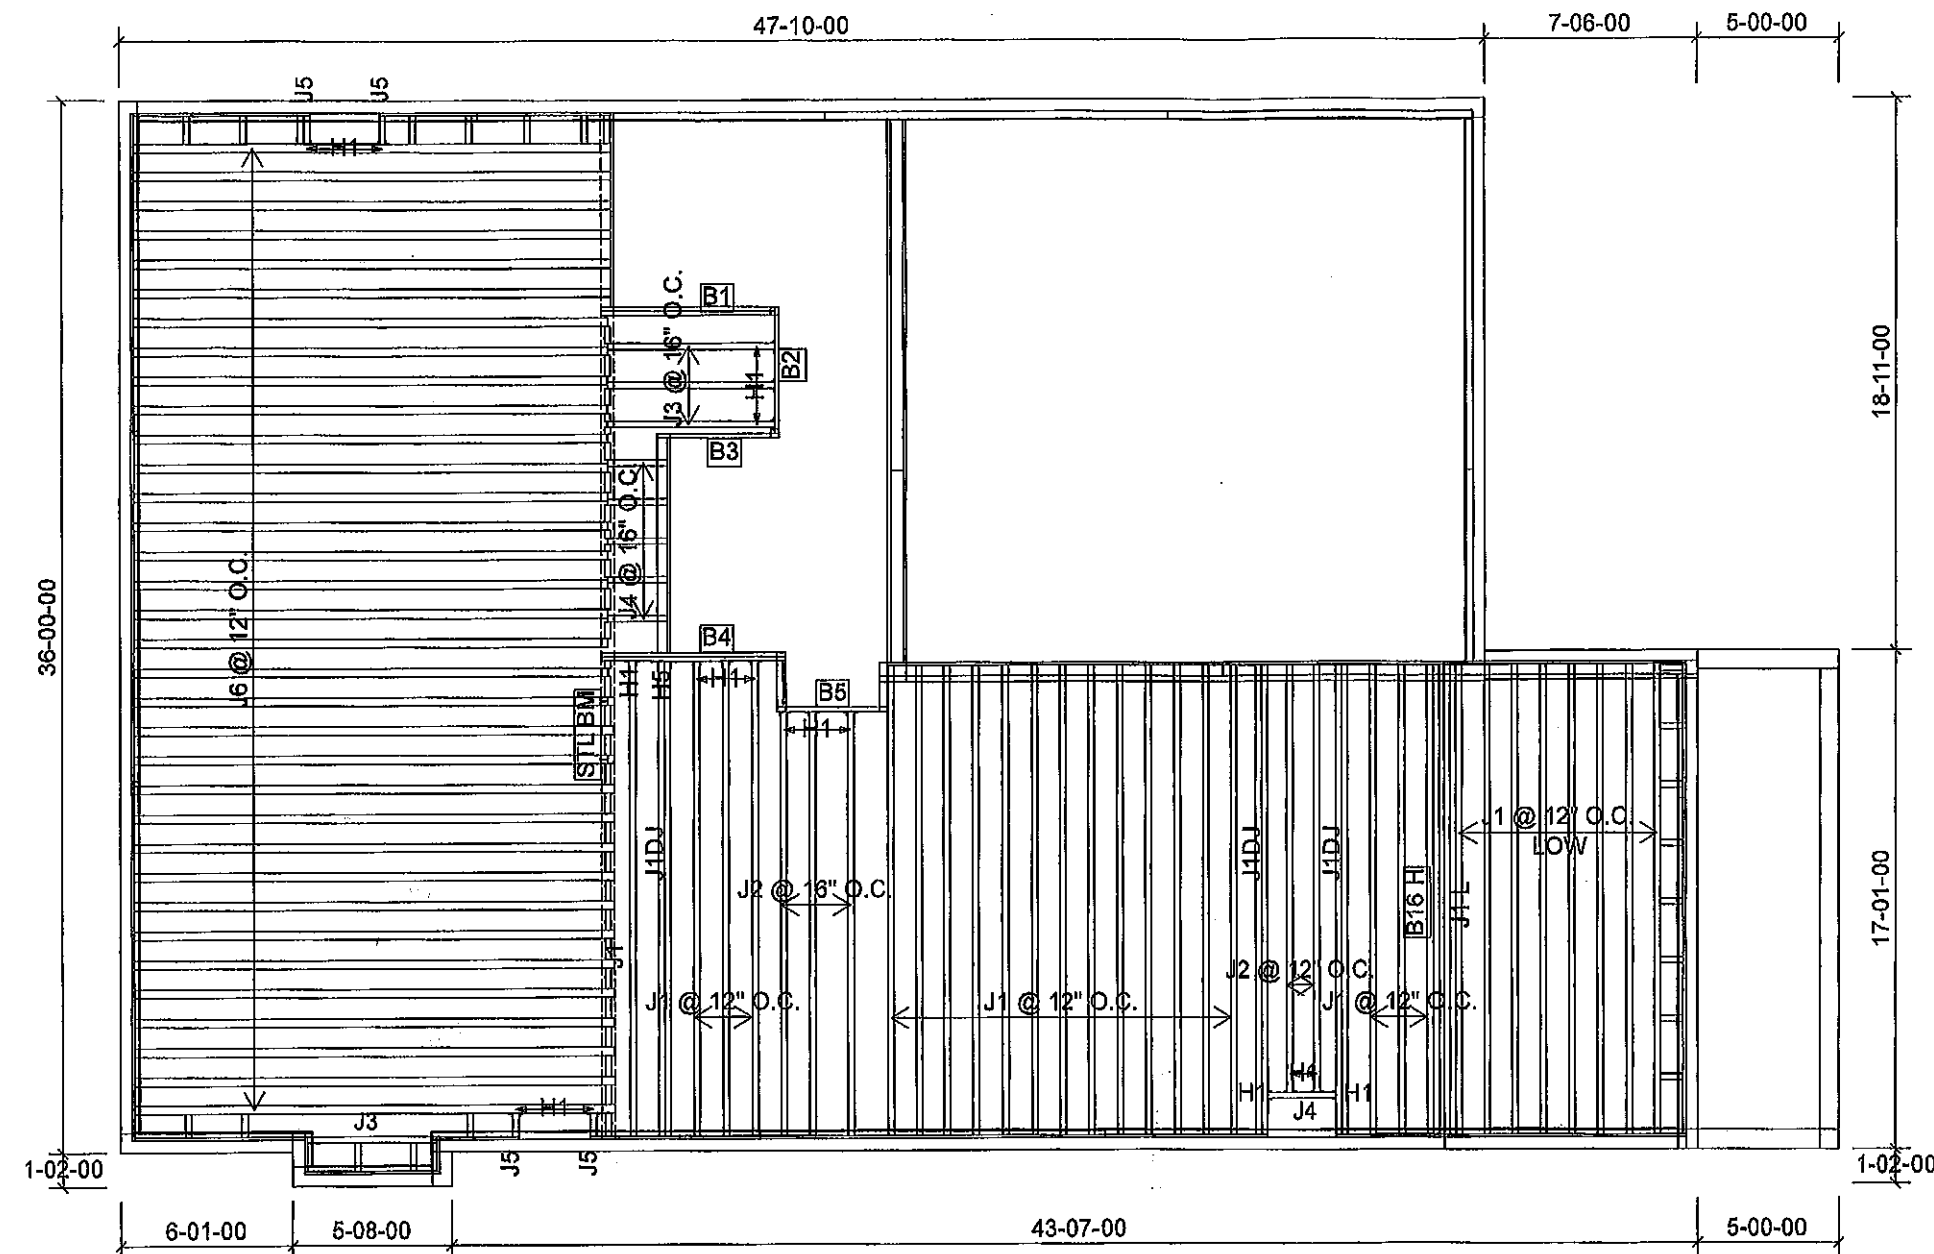

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
J1	18-00-00	9 1/2" NI-40x	1	28	MFD
J1 L	18-00-00	9 1/2" NI-40x	1	1	MFD
J1DJ	18-00-00	9 1/2" NI-40x	2	6	MFD
J2	16-00-00	9 1/2" NI-40x	1	5	MFD
J3	6-00-00	9 1/2" NI-40x	1	4	MFD
J4	4-00-00	9 1/2" NI-40x	1	6	MFD
J5	2-00-00	9 1/2" NI-40x	1	4	MFD
J6	18-00-00	9 1/2" NI-80	1	34	MFD
B16 H	18-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B4	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B2	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B3	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B1	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B5	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD

Connector Summary		
Qty	Manuf	Product
6	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
2	H1	IUS2.56/9.5
2	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
1	H5	HU312-2

Permit No. 107176
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
FOR CHIEF BUILDING OFFICIAL
DATE FEB 23 2021

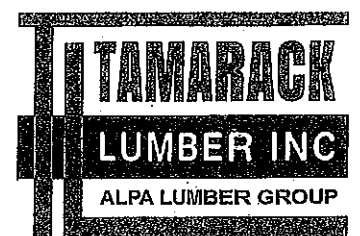

FROM PLAN DATED: AUG 28, 2020

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS PH 3

MODEL: MOUNTAINASH 5

ELEVATION: 2

LOT: 335

CITY: WATERDOWN

SALESMAN: MARIO DICIANO

DESIGNER: AJ

REVISION: L.D.

NOTES:

REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPL SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALOI BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIEL CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 8 OF THE INSTALLATION GUIDE. **CERAMIC TI** APPLICATION AS PER O.B.C. 9.30.6

LOADING:

DESIGN LOADS: L/480.000


LIVE LOAD: 40.0 lb/ft²

DEAD LOAD: 20.0 lb/ft²

SUBFLOOR: 5/8" GLUED AND NAILED


DATE: 2020-09-16

2nd FLOOR

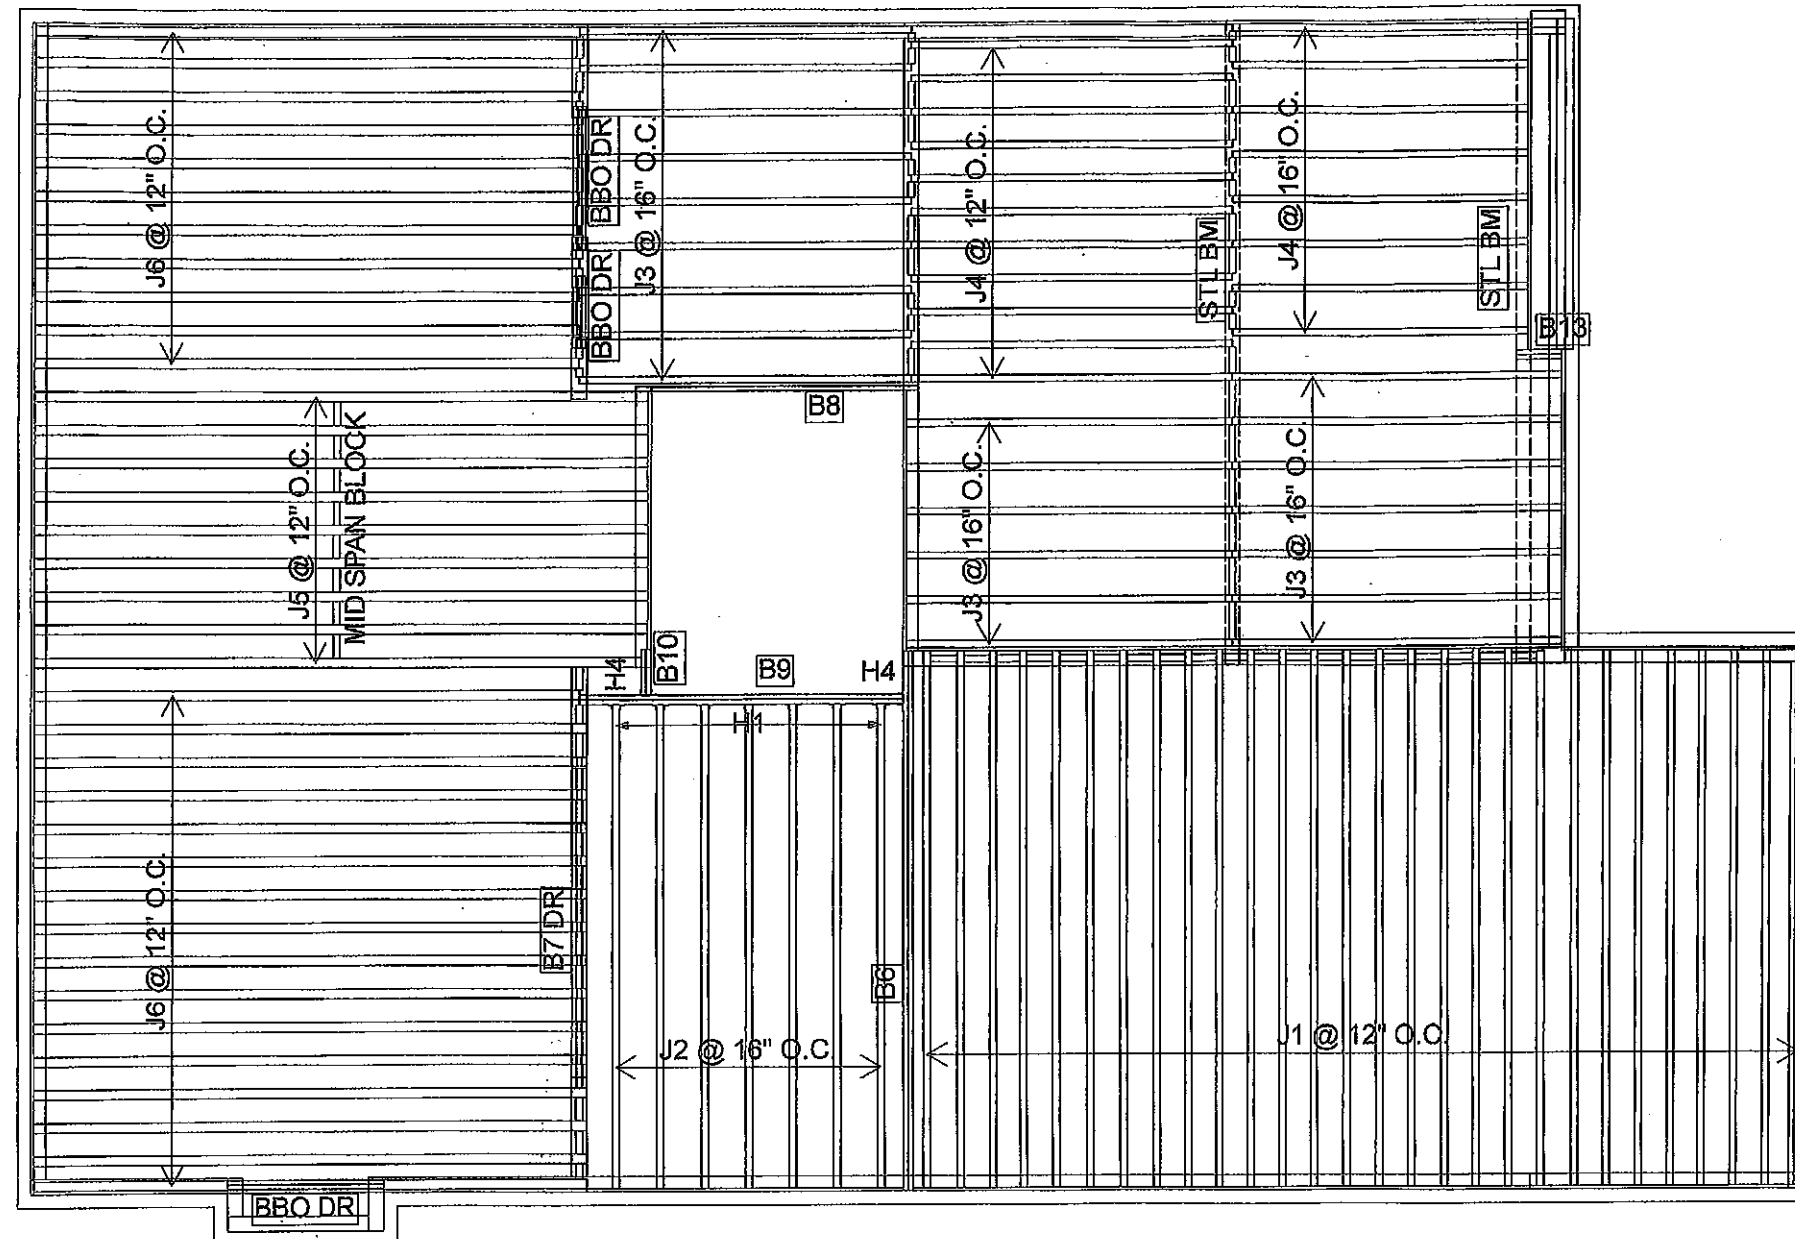

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
J1	18-00-00	9 1/2" NI-40x	1	28	MFD
J2	16-00-00	9 1/2" NI-40x	1	7	MFD
J3	12-00-00	9 1/2" NI-40x	1	22	MFD
J4	10-00-00	9 1/2" NI-40x	1	19	MFD
J5	20-00-00	9 1/2" NI-80	1	9	MFD
J6	18-00-00	9 1/2" NI-80	1	27	MFD
B6	18-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B8	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B9	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B7 DR	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3	MFD
B10	2-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B13	2-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD

Connector Summary		
Qty	Manuf	Product
7	H1	IUS2.56/9.5
2	H4	HGUS410

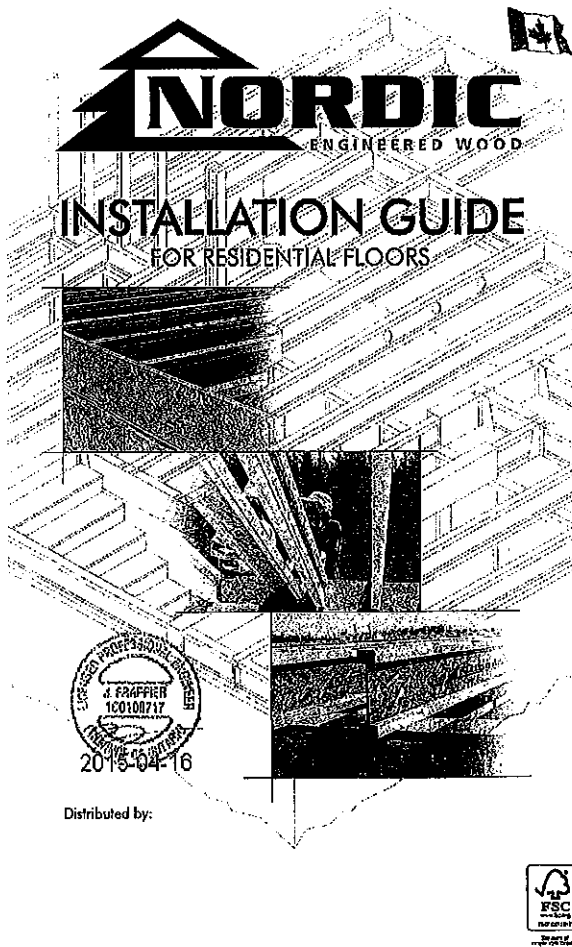

SAFETY AND CONSTRUCTION PRECAUTIONS

WARNING
I-joists are not stable until completely installed, and will not carry any load until fully braced and sheathed.

Do not walk on I-joists until fully fastened and braced, or serious injuries can result.

Never stack building materials over unbraced I-joists. Once sheathed, do not over-stress I-joist with concentrated loads from building materials.

Improper storage or installation, failure to follow applicable building codes, failure to follow span ratings for Nordic I-joists, failure to follow allowable hole size and locations, or failure to use web stiffeners when required can result in serious accidents. Follow these installation guidelines carefully.

Avoid Accidents by Following these Important Guidelines:

- Brace and nail each I-joist as it is installed, using hangers, blocking panels, rim board, and/or cross-briding at joist ends. When I-joists are applied continuous over interior supports and a load-bearing wall is planned at that location, blocking will be required at the interior support.
- When the building is completed, the floor sheathing will provide lateral support for the top flanges of the I-joists. Until this sheathing is applied, temporary bracing, often called struts, or temporary sheathing must be applied to prevent I-joist rollover or buckling.
 - Temporary bracing or struts must be 1x4 inch minimum, at least 8 feet long and spaced no more than 8 feet on center, and must be secured with a minimum of two 2-1/2" nails fastened to the top surface of each I-joist. Nail the bracing to a lateral restraint at the end of each bay. Top ends of adjoining bracing must be at least two I-joists.
 - Or, shooting temporary or permanent can be nailed to the top flange of the first 4 feet of I-joists at the end of the bay.
- For cantilevered I-joists, brace top and bottom flanges, and brace ends with diaphragm panels, rim board, or cross-briding.
- Install and fully nail permanent sheathing to each I-joist before placing loads on the floor system. Then, stack building materials over beams or walls only.
- Never install a damaged I-joist.

STORAGE AND HANDLING GUIDELINES

- Bundle wrap can be slippery when wet. Avoid walking on wrapped bundles.
- Store, stack, and handle I-joists vertically and level only.
- Always stack and handle I-joists in the upright position only.
- Do not store I-joists in direct contact with the ground and/or flatwise.
- Protect I-joists from weather, and use spacers to separate bundles.
- Bundled units should be kept intact until time of installation.
- When handling I-joists with a crane on the job site, take a few simple precautions to prevent damage to the I-joists and injury to your work crew.
 - Pick I-joists in bundles as shipped by the supplier.
 - Orient the bundles so that the webs of the I-joists are vertical.
 - Pick the bundles at the 5th points, using a spreader bar if necessary.
- Do not handle I-joists in a horizontal orientation.
- NEVER USE OR TRY TO REPAIR A DAMAGED I-JOIST.

MAXIMUM FLOOR SPANS

1. Maximum clear spans applicable to single-span or multiple-span residential floor construction with a design live load of 40 psl and dead load of 15 psl. The ultimate live loads are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration and a deflection limit of L/480. For multiple-span applications, the end spans shall be 40% or more of the adjacent span.

2. Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less, or 3/4 inch for joist spacing of 24 inches. Adhesive shall meet the requirements given in CGS-71.26 Standard. No concrete topping or bridging element was assumed. Increased spans may be achieved with the use of gypsum and/or a row of blocking at mid-span.

3. Minimum bearing length shall be 1-3/4 inches for the end bearings, and 3-1/2 inches for the intermediate bearings.

4. Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.

5. This span chart is based on uniform loads. For applications with other than uniform loads, an engineering analysis may be required based on the use of the design properties.

6. Tables are based on Limit States Design per CAN/CSA O86-09 Standard, and NBC 2010.

7. SI units conversion: 1 inch = 25.4 mm
1 foot = 0.305 m

MAXIMUM FLOOR SPANS FOR NORDIC I-JOISTS

SINGLE AND MULTIPLE SPANS

Joist Depth	Joist Series	On centre spacing			On centre spacing		
		16"	19.2"	24"	16"	19.2"	24"
9-1/2"	NL-30	15'1"	14'2"	13'5"	16'3"	15'4"	14'7"
	NL-40	16'3"	15'2"	14'8"	17'5"	16'5"	15'5"
	NL-50	16'3"	15'4"	14'10"	17'7"	16'7"	15'10"
11-7/8"	NL-30	17'1"	16'1"	15'6"	18'7"	17'4"	16'10"
	NL-40	17'5"	16'5"	15'9"	19'1"	17'8"	16'11"
	NL-50	18'1"	17'0"	16'5"	19'6"	18'4"	17'2"
14"	NL-30	18'4"	17'3"	16'7"	20'3"	18'9"	18'1"
	NL-40	19'4"	18'0"	17'4"	21'6"	19'11"	19'0"
	NL-50	19'9"	18'3"	17'7"	21'9"	20'2"	19'3"
16"	NL-30	20'2"	18'7"	17'10"	22'5"	20'7"	19'6"
	NL-40	20'4"	18'9"	17'11"	22'7"	20'9"	19'8"
	NL-50	20'9"	19'1"	18'1"	22'7"	20'11"	20'4"
18"	NL-30	21'7"	19'11"	18'4"	23'6"	21'11"	21'2"
	NL-40	21'7"	20'3"	19'4"	23'6"	22'5"	21'3"
	NL-50	22'5"	20'9"	19'9"	24'9"	22'10"	21'10"
20"	NL-30	22'7"	20'11"	19'11"	25'0"	23'1"	22'0"
	NL-40	22'7"	20'11"	19'11"	25'0"	23'1"	22'0"
	NL-50	23'6"	21'9"	20'9"	26'0"	24'0"	22'11"
22"	NL-30	23'11"	21'11"	21'2"	26'5"	24'5"	23'4"
	NL-40	24'5"	22'6"	21'5"	27'1"	24'10"	23'9"
	NL-50	24'9"	22'6"	21'9"	27'2"	25'0"	24'1"

I-JOIST HANGERS

- Hangers shown illustrate the three most commonly used metal hangers to support I-joists.
- All nailing must meet the hanger manufacturer's recommendations.
- Hangers should be selected based on the joist depth, flange width and load capacity based on the maximum spans.
- Web stiffeners are required when the sides of the hangers do not laterally brace the top flange of the I-joist.

WEB STIFFENERS

RECOMMENDATIONS:

- A bearing stiffener is required in all engineered applications with factored reactions greater than shown in the I-joist properties table found in the I-joist Construction Guide (C101). The gap between the stiffener and the flange is at the top.
- A bearing stiffener is required when the I-joist is supported in a hanger and the sides of the hanger do not extend up to, and support, the top flange. The gap between the stiffener and flange is at the top.
- A load stiffener is required at locations where a factored concentrated load greater than 2,370 lbs is applied to the top flange between supports, or in the case of a cantilever, anywhere between the cantilever tip and the support. These values are for standard term load duration, and may be adjusted for other load durations as permitted by the code. The gap between the stiffener and the flange is at the bottom.

SI units conversion: 1 inch = 25.4 mm

FIGURE 2 WEB STIFFENER INSTALLATION DETAILS

See table below for web stiffener size requirements

STIFFENER SIZE REQUIREMENTS

Flange Width	Web Stiffener Size Each Side of Web
2-1/2"	1" x 2-5/16" minimum width
3-1/2"	1-1/2" x 2-5/16" minimum width

NORDIC I-JOIST SERIES

Chondra Chibougoum Ltd. harvests its own trees, which enables Nordic products to adhere to strict quality control procedures throughout the manufacturing process. Every phase of the operation, from the raw material, through the manufacturing process, reflects our commitment to quality.

Nordic Engineered Wood I-joists use only finger-jointed back flange lumber in their flanges, ensuring consistent quality, superior strength, and longer span carrying capacity.

INSTALLING NORDIC I-JOISTS

- Before laying out floor system components, verify that I-joist flange widths match hanger widths. If not, contact your supplier.
- Except for cutting to length, I-joist flanges should never be cut, drilled, or notched.
- Install I-joists so that top and bottom flanges are within 1/2 inch of true vertical alignment.
- I-joists must be anchored securely to supports before floor sheathing is attached, and supports for multiple-span construction must be level.
- Minimum bearing lengths: 1-3/4 inches for end bearings and 3-1/2 inches for intermediate bearings.
- When using hangers, seal I-joists firmly in hanger bottoms to minimize settlement.
- Leave a 1/16-inch gap between the I-joist end and a leader.
- Concentrated loads greater than those that can normally be expected in residential construction should only be applied to the top surface of the top flange. Normal concentrated loads include track lighting fixtures, audio equipment and security cameras. Never suspend unusual or heavy loads from the I-joist's bottom flange. Whenever possible, suspend all concentrated loads from the top of the I-joist. Or, attach the load to blocking that has been securely fastened to the I-joist webs.
- Never install I-joists where they will be permanently exposed to weather, or where they will remain in direct contact with concrete or masonry.
- Restrain ends of floor joists to prevent rollover. Use rim board, rim joists or I-joist blocking panels.
- For I-joists installed over and beneath bearing walls, use full depth blocking panels, rim board, or squish blocks (cripple members) to transfer gravity loads through the floor system to the wall or foundation below.
- Due to shrinkage, common framing lumber set on edge may never be used as blocking or rim boards. I-joist blocking panels or other engineered wood products - such as rim board - must be cut to fit between the I-joists, and on I-joist-composite depth selected.
- Provide permanent lateral support of the bottom flange of all I-joists at interior supports of multiple-span joists. Similarly, support the bottom flange of all cantilevered I-joists at the end support next to the cantilever extension. In the completed structure, the gypsum wallboard ceiling provides this lateral support. Until the final finished ceiling is applied, temporary bracing or struts must be used.
- If square-edge panels are used, edges must be supported between I-joists with 2x4 blocking. Glue panels to blocking to minimize squeaks. Blocking is not required under structural finish flooring, such as wood strip flooring, or if a separate underlayment layer is installed.
- Nail spacing: Space nails installed to the flange's top face in accordance with the applicable building code requirements or approved building plans.

FIGURE 1 TYPICAL NORDIC I-JOIST FLOOR FRAMING AND CONSTRUCTION DETAILS

Some framing requirements such as erection bracing and blocking panels have been omitted for clarity.

Figures 3, 4 or 5

Holes may be cut in web for plumbing, wiring and duct work. See Tables 1, 2 and Figure 7.

NOTE: Never cut or notch flanges.

Nordic Lom or Structural Composite Lumber (SCL)

Nordic Lom or SCL

Figures 3, 4 or 5

Use hangers recognized in current code evaluation reports

All nails shown in the above details are assumed to be common wire nails unless otherwise noted. 3" (0.122" dia.) common spiral nails may be substituted for 2-1/2" (0.126" dia.) common wire nails. Framing lumber assumed to be Spruce-Pine-Fir No. 2 or better. Individual components not shown to scale for clarity.

1a Attach I-joist to top plate per detail 1b

1b Attach rim board to top plate using 2-1/2" wire or spiral nails at 6" o.c.

1c Attach rim joist to floor joist with one nail at top and bottom. Nail must provide 1 inch minimum penetration into floor joist. Toe-nailing may be used.

1d Attach rim board blocking panel per detail 1c

1e Attach rim joist to top plate per detail 1c

1f Attach rim joist to top plate per detail 1c

1g Attach rim joist to top plate per detail 1c

1h Attach rim joist to top plate per detail 1c

1i Attach rim joist to top plate per detail 1c

1j Attach rim joist to top plate per detail 1c

1k Attach rim joist to top plate per detail 1c

1l Attach rim joist to top plate per detail 1c

1m Attach rim joist to top plate per detail 1c

1n Attach rim joist to top plate per detail 1c

1o Attach rim joist to top plate per detail 1c

1p Attach rim joist to top plate per detail 1c

1q Attach rim joist to top plate per detail 1c

1r Attach rim joist to top plate per detail 1c

1s Attach rim joist to top plate per detail 1c

1t Attach rim joist to top plate per detail 1c

1u Attach rim joist to top plate per detail 1c

1v Attach rim joist to top plate per detail 1c

1w Attach rim joist to top plate per detail 1c

1x Attach rim joist to top plate per detail 1c

1y Attach rim joist to top plate per detail 1c

1z Attach rim joist to top plate per detail 1c

2a Attach rim joist to top plate per detail 1c

2b Attach rim joist to top plate per detail 1c

2c Attach rim joist to top plate per detail 1c

2d Attach rim joist to top plate per detail 1c

2e Attach rim joist to top plate per detail 1c

2f Attach rim joist to top plate per detail 1c

2g Attach rim joist to top plate per detail 1c

2h Attach rim joist to top plate per detail 1c

2i Attach rim joist to top plate per detail 1c

2j Attach rim joist to top plate per detail 1c

2k Attach rim joist to top plate per detail 1c

2l Attach rim joist to top plate per detail 1c

2m Attach rim joist to top plate per detail 1c

2n Attach rim joist to top plate per detail 1c

2o Attach rim joist to top plate per detail 1c

2p Attach rim joist to top plate per detail 1c

2q Attach rim joist to top plate per detail 1c

2r Attach rim joist to top plate per detail 1c

2s Attach rim joist to top plate per detail 1c

2t Attach rim joist to top plate per detail 1c

2u Attach rim joist to top plate per detail 1c

2v Attach rim joist to top plate per detail 1c

2w Attach rim joist to top plate per detail 1c

2x Attach rim joist to top plate per detail 1c

2y Attach rim joist to top plate per detail 1c

2z Attach rim joist to top plate per detail 1c

3a Attach rim joist to top plate per detail 1c

3b Attach rim joist to top plate per detail 1c

3c Attach rim joist to top plate per detail 1c

3d Attach rim joist to top plate per detail 1c

3e Attach rim joist to top plate per detail 1c

3f Attach rim joist to top plate per detail 1c

3g Attach rim joist to top plate per detail 1c

3h Attach rim joist to top plate per detail 1c

3i Attach rim joist to top plate per detail 1c

3j Attach rim joist to top plate per detail 1c

3k Attach rim joist to top plate per detail 1c

3l Attach rim joist to top plate per detail 1c

3m Attach rim joist to top plate per detail 1c

3n Attach rim joist to top plate per detail 1c

3o Attach rim joist to top plate per detail 1c

3p Attach rim joist to top plate per detail 1c

3q Attach rim joist to top plate per detail 1c

3r Attach rim joist to top plate per detail 1c

3s Attach rim joist to top plate per detail 1c

3t Attach rim joist to top plate per detail 1c

3u Attach rim joist to top plate per detail 1c

3v Attach rim joist to top plate per detail 1c

3w Attach rim joist to top plate per detail 1c

3x Attach rim joist to top plate per detail 1c

3y Attach rim joist to top plate per detail 1c

3z Attach rim joist to top plate per detail 1c

4a Attach rim joist to top plate per detail 1c

4b Attach rim joist to top plate per detail 1c

4c Attach rim joist to top plate per detail 1c

4d Attach rim joist to top plate per detail 1c

4e Attach rim joist to top plate per detail 1c

4f Attach rim joist to top plate per detail 1c

4g Attach rim joist to top plate per detail 1c

4h Attach rim joist to top plate per detail 1c

4i Attach rim joist to top plate per detail 1c

4j Attach rim joist to top plate per detail 1c

4k Attach rim joist to top plate per detail 1c

4l Attach rim joist to top plate per detail 1c

4m Attach rim joist to top plate per detail 1c

4n Attach rim joist to top plate per detail 1c

4o Attach rim joist to top plate per detail 1c

4p Attach rim joist to top plate per detail 1c

4q Attach rim joist to top plate per detail 1c

4r Attach rim joist to top plate per detail 1c

4s Attach rim joist to top plate per detail 1c

4t Attach rim joist to top plate per detail 1c

4u Attach rim joist to top plate per detail 1c

4v Attach rim joist to top plate per detail 1c

4w Attach rim joist to top plate per detail 1c

4x Attach rim joist to top plate per detail 1c

4y Attach rim joist to top plate per detail 1c

4z Attach rim joist to top plate per detail 1c

5a Attach rim joist to top plate per detail 1c

5b Attach rim joist to top plate per detail 1c

5c Attach rim joist to top plate per detail 1c

5d Attach rim joist to top plate per detail 1c

5e Attach rim joist to top plate per detail 1c

5f Attach rim joist to top plate per detail 1c

5g Attach rim joist to top plate per detail 1c

5h Attach rim joist to top plate per detail 1c

5i Attach rim joist to top plate per detail 1c

5j Attach rim joist to top plate per detail 1c

5k Attach rim joist to top plate per detail 1c

5l Attach rim joist to top plate per detail 1c

5m Attach rim joist to top plate per detail 1c

5n Attach rim joist to top plate per detail 1c

5o Attach rim joist to top plate per detail 1c

5p Attach rim joist to top plate per detail 1c

5q Attach rim joist to top plate per detail 1c

5r Attach rim joist to top plate per detail 1c

5s Attach rim joist to top plate per detail 1c

5t Attach rim joist to top plate per detail 1c

5u Attach rim joist to top plate per detail 1c

5v Attach rim joist to top plate per detail 1c

5w Attach rim joist to top plate per detail 1c

5x Attach rim joist to top plate per detail 1c

5y Attach rim joist to top plate per detail 1c

5z Attach rim joist to top plate per detail 1c

6a Attach rim joist to top plate per detail 1c

6b Attach rim joist to top plate per detail 1c

6c Attach rim joist to top plate per detail 1c

6d Attach rim joist to top plate per detail 1c

6e Attach rim joist to top plate per detail 1c

6f Attach rim joist to top plate per detail 1c

6g Attach rim joist to top plate per detail 1c

6h Attach rim joist to top plate per detail 1c

6i Attach rim joist to top plate per detail 1c

6j Attach rim joist to top plate per detail 1c

6k Attach rim joist to top plate per detail 1c

6l Attach rim joist to top plate per detail 1c

6m Attach rim joist to top plate per detail 1c

6n Attach rim joist to top plate per detail 1c

6o Attach rim joist to top plate per detail 1c

6p Attach rim joist to top plate per detail 1c

6q Attach rim joist to top plate per detail 1c

6r Attach rim joist to top plate per detail 1c

6s Attach rim joist to top plate per detail 1c

6t Attach rim joist to top plate per detail 1c

6u Attach rim joist to top plate per detail 1c

6v Attach rim joist to top plate per detail 1c

6w Attach rim joist to top plate per detail 1c

6x Attach rim joist to top plate per detail 1c

6y Attach rim joist to top plate per detail 1c

6z Attach rim joist to top plate per detail 1c

7a Attach rim joist to top plate per detail 1c

7b Attach rim joist to top plate per detail 1c

7c Attach rim joist to top plate per detail 1c

7d Attach rim joist to top plate per detail 1c

7e Attach rim joist to top plate per detail 1c

7f Attach rim joist to top plate per detail 1c

7g Attach rim joist to top plate per detail 1c

7h Attach rim joist to top plate per detail 1c

7i Attach rim joist to top plate per detail 1c

7j Attach rim joist to top plate per detail 1c

7k Attach rim joist to top plate per detail 1c

7l Attach rim joist to top plate per detail 1c

7m Attach rim joist to top plate per detail 1c

7n Attach rim joist to top plate per detail 1c

7o Attach rim joist to top plate per detail 1c

7p Attach rim joist to top plate per detail 1c

7q Attach rim joist to top plate per detail 1c

7r Attach rim joist to top plate per detail 1c

7s Attach rim joist to top plate per detail 1c

7t Attach rim joist to top plate per detail 1c

7u Attach rim joist to top plate per detail 1c

7v Attach rim joist to top plate per detail 1c

7w Attach rim joist to top plate per detail 1c

7x Attach rim joist to top plate per detail 1c

7y Attach rim joist to top plate per detail 1c

7z Attach rim joist to top plate per detail 1c

8a Attach rim joist to top plate per detail 1c

8b Attach rim joist to top plate per detail 1c

8c Attach rim joist to top plate per detail 1c

8d Attach rim joist to top plate per detail 1c

8e Attach rim joist to top plate per detail 1c

8f Attach rim joist to top plate per detail 1c

8g Attach rim joist to top plate per detail 1c

8h Attach rim joist to top plate per detail 1c

8i Attach rim joist to top plate per detail 1c

8j Attach rim joist to top plate per detail 1c

8k Attach rim joist to top plate per detail 1c

8l Attach rim joist to top plate per detail 1c

8m Attach rim joist to top plate per detail 1c

8n Attach rim joist to top plate per detail 1c

8o Attach rim joist to top plate per detail 1c

8p Attach rim joist to top plate per detail 1c

8q Attach rim joist to top plate per detail 1c

8r Attach rim joist to top plate per detail 1c

8s Attach rim joist to top plate per detail 1c

8t Attach rim joist to top plate per detail 1c

8u Attach rim joist to top plate per detail 1c

8v Attach rim joist to top plate per detail 1c

8w Attach rim joist to top plate per detail 1c

8x Attach rim joist to top plate per detail 1c

8y Attach rim joist to top plate per detail 1c

8z Attach rim joist to top plate per detail 1c

9a Attach rim joist to top plate per detail 1c

9b Attach rim joist to top plate per detail 1c

9c Attach rim joist to top plate per detail 1c

9d Attach rim joist to top plate per detail 1c

9e Attach rim joist to top plate per detail 1c

9f Attach rim joist to top plate per detail 1c

9g Attach rim joist to top plate per detail 1c

9h Attach rim joist to top plate per detail 1c

9i Attach rim joist to top plate per detail 1c

9j Attach rim joist to top plate per detail 1c

9k Attach rim joist to top plate per detail 1c

9l Attach rim joist to top plate per detail 1c

9m Attach rim joist to top plate per detail 1c

9n Attach rim joist to top plate per detail 1c

9o Attach rim joist to top plate per detail 1c

9p Attach rim joist to top plate per detail 1c

9q Attach rim joist to top plate per detail 1c

9r Attach rim joist to top plate per detail 1c

9s Attach rim joist to top plate per detail 1c

9t Attach rim joist to top plate per detail 1c

9u Attach rim joist to top plate per detail 1c

9v Attach rim joist to top plate per detail 1c

9w Attach rim joist to top plate per detail 1c

9x Attach rim joist to top plate per detail 1c

9y Attach rim joist to top plate per detail 1c

9z Attach rim joist to top plate per detail 1c

10a Attach rim joist to top plate per detail 1c

10b Attach rim joist to top plate per detail 1c

10c Attach rim joist to top plate per detail 1c

10d Attach rim joist to top plate per detail 1c

10e Attach rim joist to top plate per detail 1c

10f Attach rim joist to top plate per detail 1c

10g Attach rim joist to top plate per detail 1c

10h Attach rim joist to top plate per detail 1c

10i Attach rim joist to top plate per detail 1c

10j Attach rim joist to top plate per detail 1c

10k Attach rim joist to top plate per detail 1c

10l Attach rim joist to top plate per detail 1c

10m Attach rim joist to top plate per detail 1c

10n Attach rim joist to top plate per detail 1c

10o Attach rim joist to top plate per detail 1c

10p Attach rim joist to top plate per detail 1c

10q Attach rim joist to top plate per detail 1c

10r Attach rim joist to top plate per detail 1c

10s Attach rim joist to top plate per detail 1c

10t Attach rim joist to top plate per detail 1c

10u Attach rim joist to top plate per detail 1c

10v Attach rim joist to top plate per detail 1c

10w Attach rim joist to top plate per detail 1c

10x Attach rim joist to top plate per detail 1c

10y Attach rim joist to top plate per detail 1c

10z Attach rim joist to top plate per detail 1c

11a Attach rim joist to top plate per detail 1c

11b Attach rim joist to top plate per detail 1c

11c Attach rim joist to top plate per detail 1c

11d Attach rim joist to top plate per detail 1c

11e Attach rim joist to top plate per detail 1c

11f Attach rim joist to top plate per detail 1c

11g Attach rim joist to top plate per detail 1c

11h Attach rim joist to top plate per detail 1c

11i Attach rim joist to top plate per detail 1c

11j Attach rim joist to top plate per detail 1c

11k Attach rim joist to top plate per detail 1c

11l Attach rim joist to top plate per detail 1c

11m Attach rim joist to top plate per detail 1c

11n Attach rim joist to top plate per detail 1c

11o Attach rim joist to top plate per detail 1c

11p Attach rim joist to top plate per detail 1c

11q Attach rim joist to top plate per detail 1c

11r Attach rim joist to top plate per detail 1c


11s Attach rim joist to top plate per detail 1c

11t Attach rim joist to top plate per detail 1c


11u Attach rim joist to top plate per detail 1c

CANTILEVER DETAILS FOR BALCONIES (NO WALL LOAD)

3a) I-JOIST CANTILEVER DETAIL FOR BALCONIES (No Wall Load)

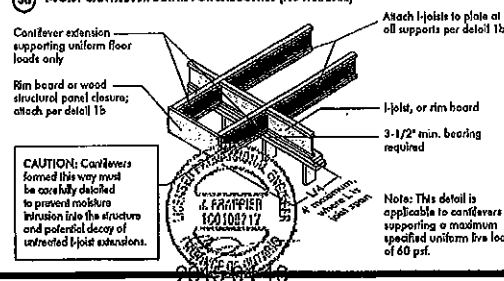


3b) LUMBER CANTILEVER DETAIL FOR BALCONIES (No Wall Load)

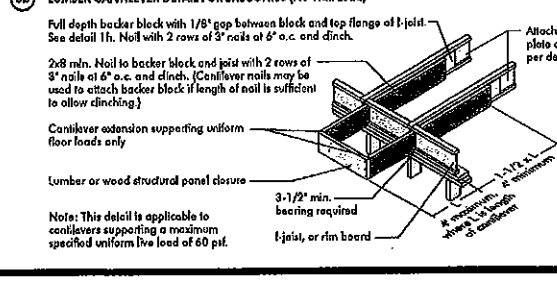


CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET (CONCENTRATED WALL LOAD)

4a) Method 1 — SHEATHING REINFORCEMENT ONE SIDE

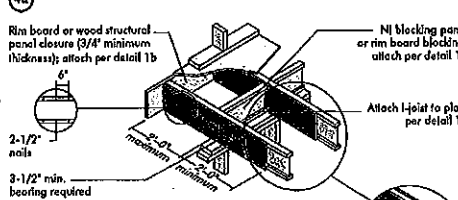

Method 2 — SHEATHING REINFORCEMENT TWO SIDES

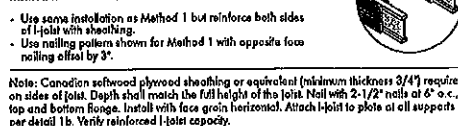

4b) Alternate Method 2 — DOUBLE I-JOIST


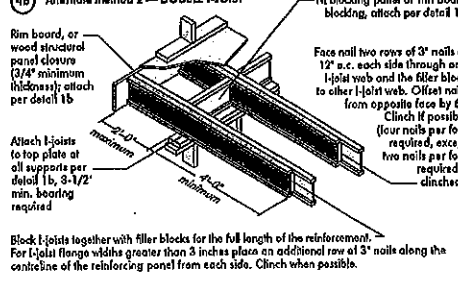


FIGURE 4 (continued)




CANTILEVER REINFORCEMENT METHODS ALLOWED

JOIST DEPTH (in.)	ROOF TRUSS SPAN (ft.)	1 = 30 psf, DL = 15 psf				1 = 40 psf, DL = 15 psf				1 = 50 psf, DL = 15 psf			
		12	16	19.2	24	12	16	19.2	24	12	16	19.2	24
9-1/2"	26	N	N	N	N	N	N	N	N	N	N	N	N
	28	N	N	N	N	N	N	N	N	N	N	N	N
	30	N	N	N	N	N	N	N	N	N	N	N	N
	32	N	N	N	N	N	N	N	N	N	N	N	N
	34	N	N	N	N	N	N	N	N	N	N	N	N
11-7/8"	26	N	N	N	N	N	N	N	N	N	N	N	N
	28	N	N	N	N	N	N	N	N	N	N	N	N
	30	N	N	N	N	N	N	N	N	N	N	N	N
	32	N	N	N	N	N	N	N	N	N	N	N	N
	34	N	N	N	N	N	N	N	N	N	N	N	N
14"	26	N	N	N	N	N	N	N	N	N	N	N	N
	28	N	N	N	N	N	N	N	N	N	N	N	N
	30	N	N	N	N	N	N	N	N	N	N	N	N
	32	N	N	N	N	N	N	N	N	N	N	N	N
	34	N	N	N	N	N	N	N	N	N	N	N	N
16"	26	N	N	N	N	N	N	N	N	N	N	N	N
	28	N	N	N	N	N	N	N	N	N	N	N	N
	30	N	N	N	N	N	N	N	N	N	N	N	N
	32	N	N	N	N	N	N	N	N	N	N	N	N
	34	N	N	N	N	N	N	N	N	N	N	N	N


1. N = No reinforcement required.
 2. 1 = Reinforced with 3/4 inch wood structural panel on one side only.
 3. 2 = Reinforced with 3/4 inch wood structural panel on both sides, or double I-joist.
 4. X = Try a deeper joist or closer spacing.
- For larger openings, or multiple 2'-0" width openings spaced less than 6'-0" o.c., additional joists beneath the opening's cripple studs may be required.
- Tables apply to joists 12" to 24" o.c. that meet the floor span requirements for a design live load of 40 psf and dead load of 15 psf, and a live load deflection limit of L/480. Use 12" o.c. requirements for lesser spacing.
- For conventional roof construction using a ridge beam, the Roof Truss Span column above is equivalent to the distance between the supporting wall and the ridge beam. When the roof is framed using a ridge board, the Roof Truss Span is equivalent to the distance between the supporting walls as the truss is used.
5. Conventional joists supporting girder trusses or roof beams may require additional reinforcement.

BRICK CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET (CONCENTRATED WALL LOAD)

5a) SHEATHING REINFORCEMENT

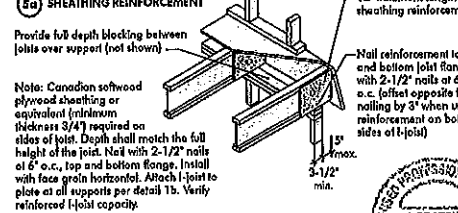

5b) SET-BACK DETAIL

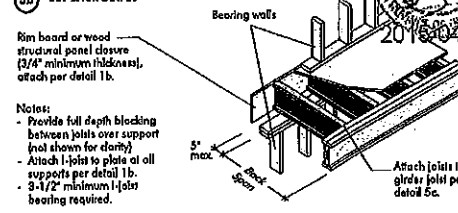

5c) SET-BACK CONNECTION

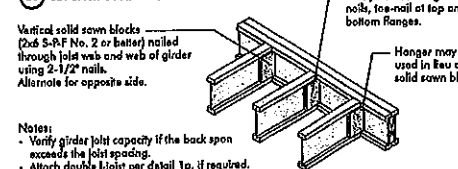


FIGURE 5 (continued)



BRICK CANTILEVER REINFORCEMENT METHODS ALLOWED

JOIST DEPTH (in.)	ROOF TRUSS SPAN (ft.)	1 = 30 psf, DL = 15 psf				1 = 40 psf, DL = 15 psf				1 = 50 psf, DL = 15 psf			
		12	16	19.2	24	12	16	19.2	24	12	16	19.2	24
9-1/2"	26	N	N	N	N	N	N	N	N	N	N	N	N
	28	N	N	N	N	N	N	N	N	N	N	N	N
	30	N	N	N	N	N	N	N	N	N	N	N	N
	32	N	N	N	N	N	N	N	N	N	N	N	N
	34	N	N	N	N	N	N	N	N	N	N	N	N
11-7/8"	26	N	N	N	N	N	N	N	N	N	N	N	N
	28	N	N	N	N	N	N	N	N	N	N	N	N
	30	N	N	N	N	N	N	N	N	N	N	N	N
	32	N	N	N	N	N	N	N	N	N	N	N	N
	34	N	N	N	N	N	N	N	N	N	N	N	N
14"	26	N	N	N	N	N	N	N	N	N	N	N	N
	28	N	N	N	N	N	N	N	N	N	N	N	N
	30	N	N	N	N	N	N	N	N	N	N	N	N
	32	N	N	N	N	N	N	N	N	N	N	N	N
	34	N	N	N	N	N	N	N	N	N	N	N	N
16"	26	N	N	N	N	N	N	N	N	N	N	N	N
	28	N	N	N	N	N	N	N	N	N	N	N	N
	30	N	N	N	N	N	N	N	N	N	N	N	N
	32	N	N	N	N	N	N	N	N	N	N	N	N
	34	N	N	N	N	N	N	N	N	N	N	N	N

1. N = No reinforcement required.
 2. 1 = Reinforced with 3/4 inch wood structural panel on one side only.
 3. 2 = Reinforced with 3/4 inch wood structural panel on both sides, or double I-joist.
 4. X = Try a deeper joist or closer spacing.
- For larger openings, or multiple 2'-0" width openings spaced less than 6'-0" o.c., additional joists beneath the opening's cripple studs may be required.
- Tables apply to joists 12" to 24" o.c. that meet the floor span requirements for a design live load of 40 psf and dead load of 15 psf, and a live load deflection limit of L/480. Use 12" o.c. requirements for lesser spacing.
5. Conventional joists supporting girder trusses or roof beams may require additional reinforcement.

WEB HOLES

RULES FOR CUTTING HOLES AND DUCT CHASE OPENINGS:

1. The distance between the inside edge of the support and the centreline of any hole or duct chase opening shall be in compliance with the requirements of Table 1 or 2, respectively.
2. I-joist top and bottom flanges must NEVER be cut, notched, or otherwise modified.
3. Whenever possible, field-cut holes should be centred on the middle of the web.
4. The maximum size hole or the maximum depth of a duct chase opening that can be cut into an I-joist web shall equal the clear distance between the flanges of the I-joist minus 1/4 inch. A minimum of 1/8 inch should always be maintained between the top or bottom of the hole or opening and the adjacent I-joist flange.
5. The sides of square holes or longest sides of rectangular holes should not exceed 3/4 of the diameter of the maximum round hole permitted at that location.
6. Where more than one hole is necessary, the distance between adjacent hole edges shall exceed twice the diameter of the largest round hole or twice the size of the largest square hole or twice the length of the longest side of the largest rectangular hole or duct chase opening, and each hole and duct chase opening shall be sized and located in compliance with the requirements of Tables 1 and 2, respectively.
7. A knockout is not considered a hole, may be utilized anywhere it occurs, and may be ignored for purposes of calculating minimum distances between holes and/or duct chase openings.
8. Holes measuring 1-1/2 inches or smaller shall be permitted anywhere in a cantilevered section of a joist. Holes of greater size may be permitted subject to verification.
9. A 1-1/2 inch hole or smaller can be placed anywhere in the web provided that it meets the requirements of rule number 6 above.
10. All holes and duct chase openings shall be cut in a workman-like manner in accordance with the restrictions listed above and as illustrated in Figure 7.
11. Limit three maximum size holes per span, of which one may be a duct chase opening.
12. A group of round holes of approximately the same location shall be permitted if they meet the requirements for a single round hole as described around them.

TABLE 1 LOCATION OF CIRCULAR HOLES IN JOIST WEBS

LOCATION OF CIRCULAR HOLES IN JOIST WEBS														
Simple or Multiple Pans for Dead loads up to 15 psi and Live loads up to 40 psf														
Joist Depth	Joist Series	Minimum distance from inside face of any support to center of hole (in.)												Span Adjustment Factor
		2	3	4	5	6	7	8	9	10	10-3/4	11	12	
9-1/2"	26	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
	28	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
	30	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
	32	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
	34	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
11-7/8"	26	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
	28	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
	30	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
	32	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
	34	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
14"	26	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
	28	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
	30	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
	32	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
	34	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
16"	26	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
	28	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
	30	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
	32	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
	34	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2

1. Above table may be used for joist spacing of 24 inches on centre or less.
2. Hole location distance is measured from inside face of support to centre of hole.
3. Distances in this chart are based on uniformly loaded joists.

OPTIONAL:

The above table is based on the I-joists used at their maximum span. If the I-joists are placed at less than their full maximum span (see Manufacturer's literature for details), the minimum distance from the centre of the hole to the face of any support (D) as given above may be reduced as follows:

Reduced = $\frac{D}{S} \times D$

Where:

- Reduced = Distance from the inside face of any support to centre of hole, reduced for less than maximum span application.
- D = Distance from the inside face of any support to centre of hole.
- S = Span.

If the reduced distance is less than 12 inches, use 12 inches.

FIGURE 7 FIELD-CUT HOLE LOCATOR


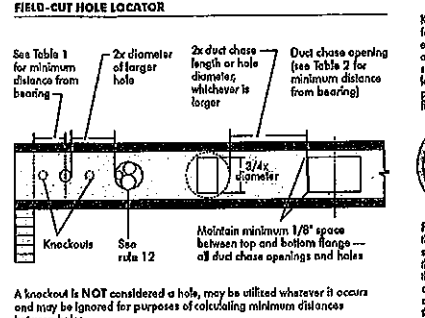


TABLE 2 DUCT CHASE OPENING SIZES AND LOCATIONS — Simple Span Only

The contractor's convenience to install medical or small plumbing lines. They are 1-1/2 inches in diameter, and are spaced 16 inches on center along the length of the Joist. Where possible, it is preferable to use knockouts instead of field-cut holes.		Joist Series													
Joist Depth	Joist Series	Bolt chord length (in.)													
		8	10	12	14	16	18	20	22	24	26	28			
9-1/2"	26	12	16	19.2	24	28	32	36	40	44	48	52	56		
	28	12	16	19.2	24	28	32	36	40	44	48	52	56		
	30	12	16	19.2	24	28	32	36	40	44	48	52	56		
	32	12	16	19.2	24	28	32	36	40	44	48	52	56		
	34	12	16	19.2	24	28	32	36	40	44	48	52	56		
11-7/8"	26	12	16	19.2	24	28	32	36	40	44	48	52	56		
	28	12	16	19.2	24	28	32	36	40	44	48	52	56		
	30	12	16	19.2	24	28	32	36	40	44	48	52	56		
	32	12	16	19.2	24	28	32	36	40	44	48	52	56		
	34	12	16	19.2	24	28	32	36	40	44	48	52	56		
14"	26	12	16	19.2	24	28	32	36	40	44	48	52	56		
	28	12	16	19.2	24	28	32	36	40	44	48	52	56		
	30	12	16	19.2	24	28	32	36	40	44	48	52	56		
	32	12	16	19.2	24	28	32	36	40	44	48	52	56		
	34	12	16	19.2	24	28	32	36	40	44	48	52	56		
16"	26	12	16	19.2	24	28	32	36	40	44	48	52	56		
	28	12	16	19.2	24	28	32	36	40	44	48	52	56		
	30	12	16	19.2	24	28	32	36	40	44	48	52	56		
	32	12	16	19.2	24	28	32	36	40	44	48	52	56		
	34	12	16	19.2	24	28	32	36	40	44	48	52	56		



Never drill, cut or notch the flange, or over-cut the web.

Holes in webs should be cut with a sharp saw.

For rectangular holes, avoid over-cutting the corners, as this can cause unnecessary stress concentrations. Slightly rounding the corners is recommended. Notching is not recommended.



Refer to the Installation Guide for Residential Floors for additional information.
CCMC EVALUATION REPORT 13032-R



Joist Series	1950F MSR	2100F MSR	1950F MSR	2100F MSR	2400F MSR	NPG Lumber
33 pieces per unit	33 pieces per unit	33 pieces per unit	33 pieces per unit	33 pieces per unit	33 pieces per unit	33 pieces per unit

WEB HOLE SPECIFICATIONS

RULES FOR CUTTING HOLES AND DUCT CHASE OPENINGS:

- The distance between the inside edge of the support and the centerline of any hole or duct chase opening shall be in compliance with the requirements of Table 1 or 2, respectively.
- I-joist top and bottom flanges must NEVER be cut, notched, or otherwise modified.
- Whenever possible, field-cut holes should be centered on the middle of the web.
- The maximum size hole or the maximum depth of a duct chase opening that can be cut into an I-joist web shall equal the clear distance between the flanges of the I-joist minus 1/4 inch. A minimum of 1/8 inch should always be maintained between the top or bottom of the hole or opening and the adjacent I-joist flange.
- The sides of square holes or longest sides of rectangular holes shall not exceed 3/4 of the diameter of the maximum round hole permitted at that location.
- Where more than one hole is necessary, the distance between adjacent hole edges shall exceed twice the diameter of the largest round hole or twice the size of the largest square hole (or twice the length of the longest side of the longest rectangular hole or duct chase opening) and each hole and duct chase opening shall be sized and located in compliance with the requirements of Tables 1 and 2, respectively.
- A knockout is not considered a hole, may be utilized anywhere it occurs, and may be ignored for purposes of calculating minimum distances between holes and/or for duct chase openings.
- Holes measuring 1-1/2 inches or smaller are permitted anywhere in a cantilevered section of a joist. Holes of greater size may be permitted subject to verification.
- A 1-1/2 inch hole or smaller can be placed anywhere in the web provided that it meets the requirements of rule number 6 above.
- All holes and duct chase openings shall be cut in a workman-like manner in accordance with the restrictions listed above and as illustrated in Figure 7.
- Limit three maximum size holes per span, of which one may be a duct chase opening.
- A group of round holes of approximately the same location shall be permitted if they meet the requirements for a single round hole circumscribed around them.

TABLE 1
LOCATION OF CIRCULAR HOLES IN JOIST WEBS
Simple or Multiple Span for Dead Loads up to 15 psf and Live Loads up to 40 psf

Simple or Multiple Span for Dead Loads up to 10 psf and Live Loads up to 10 psf																
Joist Depth	Joist Series	Minimum Distance from Inside Face of Any Support to Centre of Hole (ft - in.)														
		Round Hole Diameter (in.)														
		2	3	4	5	6	6-1/4	7	8	8-5/8	9	10	10-3/4	11	12	12-3/4
9-1/2"	NI-20	0-7"	1-6"	2-10"	4-3"	5-8"	6-0"	---	---	---	---	---	---	---	---	---
	NI-40x	0-7"	1-6"	3-0"	4-4"	6-0"	6-4"	---	---	---	---	---	---	---	---	---
	NI-60	1-3"	2-6"	4-0"	5-4"	7-0"	7-5"	---	---	---	---	---	---	---	---	---
	NI-70	2-0"	3-4"	4-8"	6-3"	8-0"	8-4"	---	---	---	---	---	---	---	---	---
	NI-80	2-3"	3-8"	5-0"	6-6"	8-2"	8-8"	---	---	---	---	---	---	---	---	---
11-7/8"	NI-20	0-7"	0-8"	1-0"	2-4"	3-8"	4-0"	5-0"	6-6"	7-9"	---	---	---	---	---	---
	NI-40x	0-7"	0-8"	1-0"	2-4"	3-8"	4-0"	5-0"	6-6"	7-9"	---	---	---	---	---	---
	NI-60	0-7"	1-3"	2-6"	4-0"	5-4"	6-9"	7-2"	8-4"	10-0"	10-0"	---	---	---	---	---
	NI-70	1-3"	2-6"	4-0"	5-4"	6-9"	7-2"	8-4"	10-0"	10-0"	11-2"	---	---	---	---	---
	NI-80	1-6"	2-10"	4-2"	5-6"	7-0"	7-5"	8-6"	10-3"	11-4"	---	---	---	---	---	---
14"	NI-20	0-7"	0-8"	1-0"	2-4"	3-8"	4-0"	5-0"	6-6"	7-9"	---	---	---	---	---	---
	NI-40x	0-7"	0-8"	1-0"	2-4"	3-8"	4-0"	5-0"	6-6"	7-9"	---	---	---	---	---	---
	NI-60	0-7"	0-8"	1-0"	2-4"	3-8"	4-0"	5-0"	6-6"	7-9"	---	---	---	---	---	---
	NI-70	0-7"	0-8"	1-0"	2-4"	3-8"	4-0"	5-0"	6-6"	7-9"	---	---	---	---	---	---
	NI-80	0-7"	0-8"	1-0"	2-4"	3-8"	4-0"	5-0"	6-6"	7-9"	---	---	---	---	---	---
16"	NI-20	0-7"	0-8"	1-0"	2-4"	3-8"	4-0"	5-0"	6-6"	7-9"	---	---	---	---	---	---
	NI-40x	0-7"	0-8"	1-0"	2-4"	3-8"	4-0"	5-0"	6-6"	7-9"	---	---	---	---	---	---
	NI-60	0-7"	0-8"	1-0"	2-4"	3-8"	4-0"	5-0"	6-6"	7-9"	---	---	---	---	---	---
	NI-70	0-7"	0-8"	1-0"	2-4"	3-8"	4-0"	5-0"	6-6"	7-9"	---	---	---	---	---	---
	NI-80	0-7"	0-8"	1-0"	2-4"	3-8"	4-0"	5-0"	6-6"	7-9"	---	---	---	---	---	---


- Above table may be used for I-joist spacing of 24 inches on centre or less.
- Hole location distance is measured from inside face of supports to centre of hole.
- Distances in this chart are based on uniformly loaded joists.
- The above table is based on the I-joists being used of their maximum spans. The minimum distance as given above may be reduced for shorter spans; contact your local distributor.

TABLE 2
DUCT CHASE OPENING SIZES AND LOCATIONS
Simple Span Only

Joist Depth	Joist Series	Minimum distance from inside face of supports to centre of opening (ft - in.)											
		Duct Chase Length (in.)											
		8	10	12	14	16	18	20	22	24	26	28	
9-1/2"	NI-20	4-1"	4-5"	4-10"	5-4"	5-8"	6-1"	6-6"	7-1"	7-5"	8-2"	8-6"	
	NI-40x	5-3"	5-8"	6-2"	6-7"	7-1"	7-5"	7-8"	8-2"	8-7"	9-1"	9-6"	
	NI-60	5-4"	5-9"	5-12"	6-7"	7-1"	7-5"	8-0"	8-3"	8-9"	9-4"	9-8"	
	NI-70	5-1"	5-5"	5-10"	6-3"	6-7"	7-1"	7-5"	8-0"	8-3"	8-9"	9-4"	
	NI-80	5-3"	5-8"	6-0"	6-5"	6-10"	7-3"	7-8"	8-2"	8-7"	9-1"	9-6"	
11-7/8"	NI-20	5-9"	6-2"	6-6"	7-1"	7-5"	7-9"	8-3"	8-9"	9-4"	10-1"	10-4"	
	NI-40x	6-8"	7-2"	7-6"	8-1"	8-5"	9-0"	9-4"	9-9"	10-4"	10-9"	11-0"	
	NI-60	6-8"	7-3"	7-6"	8-1"	8-5"	9-0"	9-4"	9-9"	10-4"	10-9"	11-0"	
	NI-70	7-0"	7-4"	7-9"	8-3"	8-7"	9-1"	9-5"	10-1"	10-4"	10-9"	11-0"	
	NI-80	7-2"	7-7"	8-0"	8-5"	8-10"	9-3"	9-8"	10-2"	10-6"	10-11"	10-13"	
14"	NI-20	7-6"	7-11"	8-4"	8-9"	9-2"	9-7"	10-1"	10-7"	10-11"	10-15"	10-19"	
	NI-40x	7-7"	8-1"	8-5"	8-10"	9-4"	9-8"	10-2"	10-6"	11-0"	11-4"	11-8"	
	NI-60	8-1"	8-7"	9-0"	9-6"	10-1"	10-5"	11-0"	11-4"	11-8"	12-2"	12-6"	
	NI-70	8-9"	9-3"	9-8"	10-1"	10-6"	11-1"	11-5"	12-0"	12-4"	12-8"	13-2"	
	NI-80	8-7"	9-1"	9-5"	10-1"	10-6"	11-1"	11-5"	12-0"	12-4"	12-8"	13-2"	
16"	NI-20	9-2"	9-8"	10-0"	10-6"	11-1"	11-5"	11-9"	12-4"	12-8"	13-2"	13-6"	
	NI-40x	9-4"	9-9"	10-3"	10-7"	11-2"	11-7"	12-1"	12-7"	13-1"	13-6"	14-0"	
	NI-60	10-3"	10-8"	11-2"	11-6"	12-1"	12-5"	13-0"	13-4"	13-8"	14-3"	14-7"	
	NI-70	10-1"	10-5"	11-0"	11-4"	11-9"	12-3"	12-8"	13-2"	13-6"	14-1"	14-5"	
	NI-80	10-4"	10-9"	11-3"	11-8"	12-1"	12-6"	13-0"	13-4"	13-8"	14-2"	14-6"	

- Above table may be used for I-joist spacing of 24 inches on centre or less.
- Duct chase opening location distance is measured from inside face of supports to centre of opening.
- The above table is based on simple-span joists only. For other applications, contact your local distributor.
- Distances are based on uniformly loaded floor joists that meet the span requirements for a design live load of 40 psf and dead load of 15 psf, and a live load deflection limit of L/480.
- The above table is based on the I-joists being used of their maximum spans. The minimum distance as given above may be reduced for shorter spans; contact your local distributor.

FIGURE 7
FIELD-CUT HOLE LOCATOR

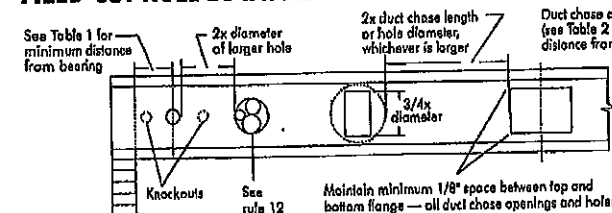

Knockouts are predrilled holes provided for the contractor's convenience to install electrical or small plumbing lines. They are 1-1/2 inches in diameter, and are spaced 15 inches on centre along the length of the I-joist. Where possible, it is preferable to use knockouts instead of field-cut holes.

Never drill, cut or notch the flange, or over-cut the web.

Holes in webs should be cut with a sharp saw.

For rectangular holes, avoid over-cutting the corners, as this can cause unnecessary stress concentrations. Slightly rounding the corners is recommended. Starting the rectangular hole by drilling a 1-inch diameter hole in each of the four corners and then making the cuts between the holes is another good method to minimize damage to the I-joist.

SAFETY AND CONSTRUCTION PRECAUTIONS



Do not walk on joists until fully braced and sheathed, or serious injuries can result.



Never stack building materials over unbraced joists. Once sheathed, do not use stairs I-joists with concentrated loads from building materials.

WARNING: I-joists are not stable until completely installed, and will not carry any load until fully braced and sheathed.

AVOID ACCIDENTS BY FOLLOWING THESE IMPORTANT GUIDELINES:

- Brace and nail each I-joist as it is installed, using hangers, blocking panels, rim board, end/or cross-bridging at joist ends. When I-joists are applied continuous over interior supports and a load-bearing wall is planned at that location, blocking will be required at the interior support.
- When the building is completed, the floor sheathing will provide lateral support for the top flanges of the I-joists. Until this sheathing is applied, temporary bracing, often called struts, or temporary sheathing must be applied to prevent I-joist rollover or buckling.
 - Temporary bracing or struts must be 1x4 inch minimum, at least 8 feet long and spaced no more than 8 feet on centre, and must be secured with a minimum of two 2-1/2" nails fastened to the top surface of each I-joist. Nail the bracing to a lateral restraint at the end of each bay. Top ends of adjoining bracing over at least two I-joists.
 - Or, sheathing (temporary or permanent) can be nailed to the top flange of the first 4 feet of I-joists at the end of the bay.
- For cantilevered I-joists, brace top and bottom flanges, and brace ends with closure panels, rim board, or cross-bridging.
- Install and fully nail permanent sheathing to each I-joist before placing loads on the floor system. Then, stack building materials over beams or walls only.
- Never install a damaged I-joist.

Improper storage or installation, failure to follow applicable building codes, failure to follow span ratings for Nordic I-joists, failure to follow allowable hole sizes and locations, or failure to use web stiffeners when required can result in serious accidents. Follow these installation guidelines carefully.



PRODUCT WARRANTY

Chautauq Chibongamun guarantees that, in accordance with our specifications, Nordic products are free from manufacturing defects in material and workmanship.

Furthermore, Chautauq Chibongamun warrants that our products, when installed in accordance with our handling and installation instructions, will meet or exceed our specifications for the lifetime of the structure.

Blocking Panel or Rim Joist

Maximum Factored Uniform Vertical Load* (psf)
3,300

*The uniform vertical load is limited to a joist depth of 16 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

Attach I-joist to top plate per detail 1b.

2-1/2" nails at 6" o.c. to top plate (when used for lateral shear transfer, nail to bearing plate with same nailing as required for decking).

Blocking Panel or Rim Joist

Maximum Factored Uniform Vertical Load* (psf)
6,090

*The uniform vertical load is limited to a rim board depth of 16 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

One 2-1/2" wire or spiral nail at top and bottom flange.

Attach rim board to top plate using 2-1/2" wire or spiral toe-nails of 6" o.c.

To avoid splitting flange, start nails at least 1-1/2" from end of I-joist. Nails may be driven at an angle to avoid splitting of bearing plate.

Minimum bearing length shall be 1-3/4" for the end bearings, and 3-1/2" for the intermediate bearings when applicable.

Pair of Squash Blocks

Maximum Factored Vertical Load per Pair of Squash Blocks (lbs)
3-1/2" wide: 5,500
5-1/2" wide: 8,500
1-1/8" Rim Board Plus: 4,800
6,600

Provide lateral bracing per detail 1a or 1b.

Joist attachment per detail 1b

Load bearing wall above shall align vertically with the bearing below. Other conditions, such as offset bearing walls, are not covered by this detail.

Blocking required over all interior supports under load-bearing walls or when floor joists are not continuous over support.

NI blocking panel per detail 1a.

2-1/2" nails at 6" o.c. to top plate.

Backer block (use if hanger load exceeds 360 lbs). Before installing a backer block to a double I-joist, drive three additional 3" nails through the webs and filler block where the backer block will fit. Clinch. Install backer block tight to top flange. Use twelve 3" nails, clinched when possible. Maximum factored resistance for hanger for this detail = 1,620 lbs.

BACKER BLOCKS (Blocks must be long enough to permit required nailing without splitting)

Flange Width	Material Thickness Required*	Minimum Depth**
2-1/2"	1"	5-1/2"
3-1/2"	1-1/2"	7-1/4"

* Minimum grade for backer block material shall be S-P-F No. 2, or better for solid sawn lumber and wood structural panels conforming to CAN/CSA-C325 or CAN/CSA-C437 Standard.

** For face-mount hangers use net joist depth minus 3-1/4" for joists with 1-1/2" thick flanges. For 2" thick flanges use net depth minus 4-1/4".

Top- or face-mount hanger

Double I-joist header

NOTE: Unless hanger sides laterally support the top flange, bearing stiffeners shall be used.

Backer block required (both sides for face-mount hangers)

For hanger capacity see hanger manufacturer's recommendations. Verify double I-joist capacity to support concentrated loads.

Filler block per detail 1p

Maximum support capacity = 1,620 lbs.

NOTE: Blocking required at bearing for lateral support, not shown for clarity.

Nordic Laminated Structural Composite Lumber (SCL)

For nailing schedules for multiple beams, see the manufacturer's recommendations.

Top- or face-mount hanger installed per manufacturer's recommendations.

NOTE: Unless hanger sides laterally support the top flange, bearing stiffeners shall be used.

2x plate flush with inside face of wall or beam. 1/8" overhang allowed past inside face of wall or beam.

NOTE: Unless hanger sides laterally support the top flange, bearing stiffeners shall be used.

Top-mount hanger installed per manufacturer's recommendations

Filler block per detail 1p

Maximum support capacity = 1,620 lbs.

Multiple I-joist header with full depth filler block shown. Nordic Laminated or SCL headers may also be used. Verify double I-joist capacity to support concentrated loads.

Backer block attached per detail 1h. Nail with twelve 3" nails, clinch when possible.

Install hanger per manufacturer's recommendations

NOTE: Blocking required at bearing for lateral support, not shown for clarity.

Do not bevel-cut joist beyond inside face of wall

Attach I-joist per detail 1b

Lumber 2x4 min., extend block to face of joist beyond inside face of wall

Two 2-1/2" spiral nails from each web to lumber piece, alternate on opposite side.

NI blocking panel

OPTIONAL: Minimum 1x4 inch strip applied to underside of joist at blocking line or 1/2 inch minimum gypsum ceiling attached to underside of joist.

FILLER BLOCK REQUIREMENTS FOR DOUBLE I-JOIST CONSTRUCTION

Filler block

Offset nails from opposite face by 6"

1/8" to 1/4" gap between top flange and filler block

NOTES:

- Support back of I-joist web during nailing to prevent damage to web/flange connection.
- Leave a 1/8 to 1/4-inch gap between top of filler block and bottom of top I-joist flange.
- Filler block is required between joists for full length of span.
- Nail joists together with two rows of 3" nails at 12 inches o.c. (clinched when possible) on each side of the double I-joist. Total of four nails per foot required. If nails can be clinched, only two nails per foot are required.
- The maximum factored load that may be applied to one side of the double joist using this detail is 860 lb/ft. Verify double I-joist capacity.

Flange Size	Net Depth	Filler Block Size
2-1/2" x 14"	9-1/2"	2-1/8" x 6"
1-1/2" x 16"	11-7/8"	2-1/8" x 8"
	14"	2-1/8" x 10"
	16"	2-1/8" x 12"
3-1/2" x 14"	9-1/2"	3" x 6"
1-1/2" x 16"	11-7/8"	3" x 8"
	14"	3" x 10"
	16"	3" x 12"
3-1/2" x 2"	11-7/8"	3" x 7"
	14"	3" x 9"
	16"	3" x 11"

One 2-1/2" nail at top and bottom flange

2x4 min. (1/8" gap minimum)

Two 2-1/2" nails from each web to lumber piece, alternate on opposite side

One 2-1/2" nail one side only

NOTE:

- In some local codes, blocking is prescriptively required in the first joist space for first and second joist space) next to the starter joist. Where required, see local code requirements for spacing of the blocking.
- All nails are common spiral in this detail.

All nails shown in the above details are assumed to be common wire nails unless otherwise noted. 3" (0.125" dia.) common spiral nails may be substituted for 2-1/2" (0.125" dia.) common wire nails. Framing lumber assumed to be Spruce-Pine-Fir No. 2 or better (trademarked companies not shown to scale for clarity).

WEB STIFFENERS

RECOMMENDATIONS:

- A bearing stiffener is required in all engineered applications with factored reactions greater than shown in the I-joist properties table found in the I-joist Construction Guide (C10). The gap between the stiffener and the flange is at the top.
- A bearing stiffener is required when the I-joist is supported in a hanger and the sides of the hanger do not extend up to, and support, the top flange. The gap between the stiffener and flange is at the top.
- A load stiffener is required at locations where a factored concentrated load greater than 2,370 lbs is applied to the top flange between supports, or in the case of a cantilever, anywhere between the cantilever tip and the support. These values are for standard term load duration, and may be adjusted for other load durations as permitted by the code. The gap between the stiffener and the flange is at the bottom.

FIGURE 2
WEB STIFFENER INSTALLATION DETAILS

Flange width 2-1/2" or 3-1/2"

Approx. 2"

1/8" - 1/4" Gap

(4) 2-1/2" nails, 3" nails required for I-joists with 3-1/2" flange width

No Gap

See the adjacent table for web stiffener size requirements

CONCENTRATED LOAD (Load stiffener)

Tight Joint No Gap

END BEARING (Bearing stiffener)

Gap

Tight Joint No Gap

STIFFENER SIZE REQUIREMENTS

Flange Width	Web Stiffener Size Each Side of Web
2-1/2"	1" x 2-5/16" minimum width
3-1/2"	1-1/2" x 2-5/16" minimum width

CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET

Method 1 — SHEATHING REINFORCEMENT ONE SIDE

Rim board or wood structural panel closure (3/4" minimum thickness); attach per detail

NORDIC STRUCTURES

COMPANY
Apr. 9, 2020 09:52


PROJECT
J1 1ST FLOOR.wwb

Design Check Calculation Sheet Nordic Sizer – Canada 7.2

Loads:

Load	Type	Distribution	Pat- tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

Maximum Reactions (lbs) and Support Bearing (in):

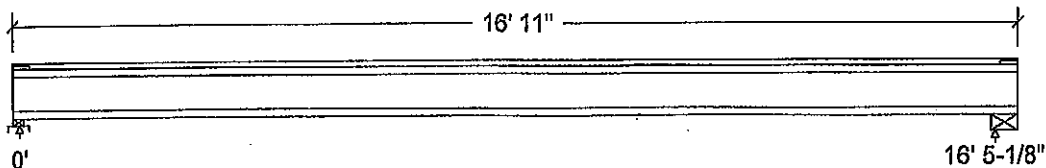

Unfactored:			
Dead	164		164
Live	329		329
Factored:			
Total	698		698
Bearing:			
Capacity			
Joist	1865		1893
Support	3971		-
Des ratio			
Joist	0.37		0.37
Support	0.18		-
Load case	#2		#2
Length	2-3/8		5-1/4
Min req'd	1-3/4		1-3/4
Stiffener	No		No
KD	1.00		1.00
KB support	1.00		-
fcp sup	769		-
Kzcp sup	1.09		-

Nordic 9-1/2" NI-40x Floor joist @ 12" o.c.

Supports: 1 - Lumber Sill plate, No.1/No.2; 2 - Steel Beam, W;
Total length: 16' 11"; Clear span: 16' 3-3/8"; 3/4" nailed and glued OSB sheathing
This section PASSES the design code check.

Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 698	Vr = 1895	lbs	Vf/Vr = 0.37
Moment (+)	Mf = 2867	Mr = 4824	lbs-ft	Mf/Mr = 0.59
Perm. Defl'n	0.14 = < L/999	0.55 = L/360	in	0.25
Live Defl'n	0.27 = L/721	0.41 = L/480	in	0.67
Total Defl'n	0.41 = L/480	0.82 = L/240	in	0.50
Bare Defl'n	0.33 = L/603	0.55 = L/360	in	0.60
Vibration	Lmax = 16'-5.1	Lv = 17'-1.8	ft	0.96
Defl'n	= 0.034	= 0.039	in	0.87



DWG NO. YAM6062-20
STRUCTURAL
COMPONENT ONLY

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
EI	218.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L

Moment(+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake
L=live(use,occupancy) Ls=live(storage,equipment) f=fire

Load Patterns: s=S/2 L=L+Ls _=no pattern load in this span

All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:E_{ieff} = 265.29 lb-in² K= 4.94e06 lbs


"Live" deflection is due to all non-dead loads (live, wind, snow...)

CONFORMS TO OBC 2012

AMENDED 2020

Design Notes:

1. WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4, and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to Nordic Structures technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



DWG NO. TAN 6062 -20
 STRUCTURAL
 COMPONENT ONLY

NORDIC STRUCTURES

COMPANY
Apr. 9, 2020 09:52


PROJECT
J1 2ND FLOOR.wwb

Design Check Calculation Sheet Nordic Sizer - Canada 7.2

Loads:

Load	Type	Distribution	Pat- tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

Maximum Reactions (lbs) and Support Bearing (in):

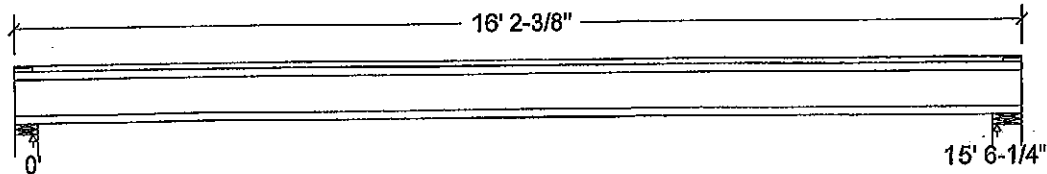

Unfactored:			
Dead	155		155
Live	310		310
Factored:			
Total	660		660
Bearing:			
Capacity			
Joist	1893		1893
Support	7744		9724
Des ratio			
Joist	0.35		0.35
Support	0.09		0.07
Load case	#2		#2
Length	4-3/8		5-1/2
Min req'd	1-3/4		1-3/4
Stiffener	No		No
KD	1.00		1.00
KB support	-		-
fcp sup	769		769
Kzcp sup	-		-

Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

Nordic 9-1/2" NI-40x Floor joist @ 12" o.c.


Supports: All - Lumber Wall, No.1/No.2

Total length: 16' 2-3/8"; Clear span: 15' 4-1/2"; 5/8" nailed and glued OSB sheathing with 1/2" gypsum ceiling

This section PASSES the design code check.

Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 660	Vr = 1895	lbs	Vf/Vr = 0.35
Moment(+)	Mf = 2559	Mr = 4824	lbs-ft	Mf/Mr = 0.53
Perm. Defl'n	0.11 = < L/999	0.52 = L/360	in	0.22
Live Defl'n	0.23 = L/825	0.39 = L/480	in	0.58
Total Defl'n	0.34 = L/550	0.78 = L/240	in	0.44
Bare Defl'n	0.26 = L/708	0.52 = L/360	in	0.51
Vibration	Lmax = 15'-6.3	Lv = 16'-8.5	ft	0.93
Defl'n	= 0.033	= 0.042	in	0.79



WWW.NO.TAW6063-20
STRUCTURAL

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
EI	218.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L

Moment(+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake

L=live(use,occupancy) Ls=live(storage,equipment) f=fire

Load Patterns: s=S/2 L=L+Ls _=no pattern load in this span

All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:E_Ieff = 258.29 lb-in² K= 4.94e06 lbs

"Live" deflection is due to all non-dead loads (live, wind, snow...)

CONFORMS TO OBC 2012

AMENDED 2020

Design Notes:

1. WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4, and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to Nordic Structures technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



096 NO. YAN 6063 -20
STRUCTURAL
COMPONENT ONLY

NORDIC STRUCTURES

COMPANY
Apr. 9, 2020 09:51


PROJECT
J6 2ND FLOOR.wwb

Design Check Calculation Sheet Nordic Sizer - Canada 7.2

Loads:

Load	Type	Distribution	Pat-tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

Maximum Reactions (lbs) and Support Bearing (in):

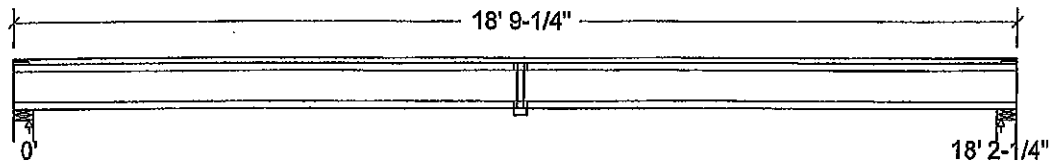

Unfactored:			
Dead	182		182
Live	364		364
Factored:			
Total	773		773
Bearing:			
Capacity			
Joist	1893		1893
Support	10841		10841
Des ratio			
Joist	0.41		0.41
Support	0.07		0.07
Load case	#2		#2
Length	4-3/8		4-3/8
Min req'd	1-3/4		1-3/4
Stiffener	No		No
KD	1.00		1.00
KB support	-		-
fcpsup	769		769
Kzcp sup	-		-

Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

Nordic 9-1/2" NI-80 Floor joist @ 12" o.c.


Supports: All - Lumber Wall, No.1/No.2

Total length: 18' 9-1/4"; Clear span: 18' 1/2"; 5/8" nailed and glued OSB sheathing with 1 row of blocking; strapping at blocking locations and 1/2" gypsum ceiling

This section **PASSES** the design code check.

Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 773	Vr = 1895	lbs	Vf/Vr = 0.41
Moment (+)	Mf = 3514	Mr = 8958	lbs-ft	Mf/Mr = 0.39
Perm. Defl'n	0.15 = < L/999	0.61 = L/360	in	0.25
Live Defl'n	0.30 = L/726	0.45 = L/480	in	0.66
Total Defl'n	0.45 = L/484	0.91 = L/240	in	0.50
Bare Defl'n	0.34 = L/649	0.61 = L/360	in	0.55
Vibration	Lmax = 18'-2.3	Lv = 20'-0.5	ft	0.91
Defl'n	= 0.028	= 0.034	in	0.81

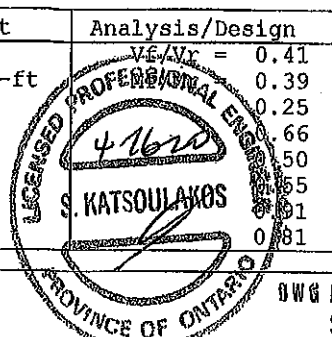

OWG NO. TAM 6064-20
STRUCTURAL

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	8958	1.00	1.00	-	1.000	-	-	-	#2
EI	324.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L

Moment(+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake

L=live(use,occupancy) Ls=live(storage,equipment) f=fire

Load Patterns: s=S/2 L=L+Ls _=no pattern load in this span

All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:E_Ieff = 367.27 lb-in² K= 4.94e06 lbs

"Live" deflection is due to all non-dead loads (live, wind, snow...)

CONFORMS TO OBC 2012

AMENDED 2020

Design Notes:

1. WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4, and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to Nordic Structures technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



UWB NO. TAM 6064-20
STRUCTURAL
COMPONENT ONLY



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****1ST FLR FRAMING\Flush Beams\B1(1498) (Flush Beam)**

Dry | 1 span | No cant.

February 7, 2020 09:30:29

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 5 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B1(1498)

Specifier:

Designer:

Company:

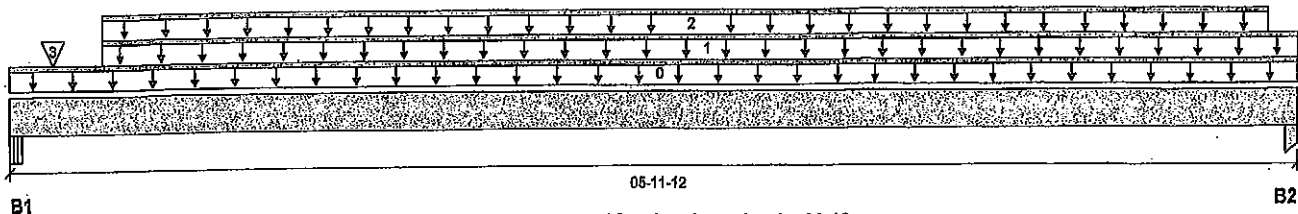

Total Horizontal Product Length = 05-11-12

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 6-1/4"	147 / 0	289 / 0		
B2, 1-3/4"	77 / 0	228 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	05-11-12	Top	1.00	0.65	1.00	1.15	00-00-00
1	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-05-04	05-11-12	Top	27	14			n/a
2	WALL	Unf. Lin. (lb/ft)	L	00-05-04	05-10-00	Top		60			n/a
3	12(1619)	Conc. Pt. (lbs)	L	00-02-08	00-02-08	Top	72	60			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	443 ft-lbs	15093 ft-lbs	2.9%	0	03-01-10
End Shear	222 lbs	7521 lbs	3.0%	0	01-02-12
Total Load Deflection	L/999 (0.005")	n/a	n/a	4	03-01-10
Live Load Deflection	L/999 (0.001")	n/a	n/a	5	03-01-10
Max Defl.	0.005"	n/a	n/a	4	03-01-10
Span / Depth	7.0				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 5-1/4" x 3-1/2"	405 lbs	7.9%	2.8%	Unspecified
B2	Column 1-3/4" x 3-1/2"	319 lbs	12.3%	6.6%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.


Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86. **AMENDED 2020**

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

PROVIDE 3 ROWS OF 3/4" ARDOX
SPIRAL NAILS @ 8" O/C FOR
MULTI-PLY NAILING, MAINTAIN
A MIN. 2" LUMBER EDGE/END
DISTANCE. DO NOT USE AIR NAILS



DWG NO. YAM 6065-20

**STRUCTURAL
COMPONENT ONLY****Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Bolsa Cascade

**Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****1ST FLR FRAMING\Flush Beams\B2(1522) (Flush Beam)**

Dry | 1 span | No cant.

PASSED

February 7, 2020 09:30:29

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 5 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B2(1522)

Specifier:

Designer:

Company:

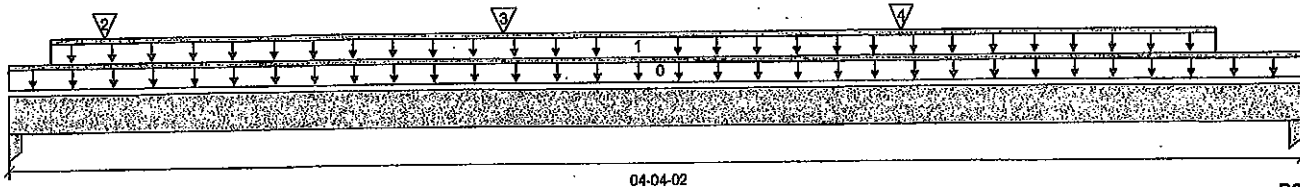

B1

Total Horizontal Product Length = 04-04-02

B2

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 1-3/4"	239 / 0	246 / 0		
B2, 3-1/2"	182 / 0	219 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	04-04-02	Top	1.00	0.65	1.00	1.15	00-00-00
1	WALL	Unf. Lin. (lb/ft)	L	00-01-12	04-00-10	Top		60			n/a
2	J4(11461)	Conc. Pt. (lbs)	L	00-03-14	00-03-14	Top	105	52			n/a
3	J4(11445)	Conc. Pt. (lbs)	L	01-07-14	01-07-14	Top	158	79			n/a
4	J4(11521)	Conc. Pt. (lbs)	L	02-11-14	02-11-14	Top	158	79			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	658 ft-lbs	11610 ft-lbs	5.7%	1	01-07-14
End Shear	480 lbs	5785 lbs	8.3%	1	03-03-02
Total Load Deflection	L/999 (0.006")	n/a	n/a	4	02-01-06
Live Load Deflection	L/999 (0.003")	n/a	n/a	5	02-01-06
Max Defl.	0.006"	n/a	n/a	4	02-01-06
Span / Depth	5.1				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Column 1-3/4" x 1-3/4"	667 lbs	33.5%	17.9%	Unspecified
B2	Column 3-1/2" x 1-3/4"	546 lbs	13.7%	7.3%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012**AMENDED 2020****DWG NO. TAN 6066-20****STRUCTURAL COMPONENT ONLY****Disclosure**

Use of the Bolsa Cascade Software is subject to the terms of the End User License Agreement (EULA).

Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Bolsa Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

**Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****1ST FLR FRAMING\Flush Beams\B3(i1455) (Flush Beam)**

Dry | 1 span | No cant.

February 7, 2020 09:30:29

BC CALCO® Member Report

Build 7239

Job name:

File name: MOUNTAINASH 5 EL 1.mmdl

Address:

Description: 1ST FLR FRAMING\Flush Beams\B3(i1455)

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

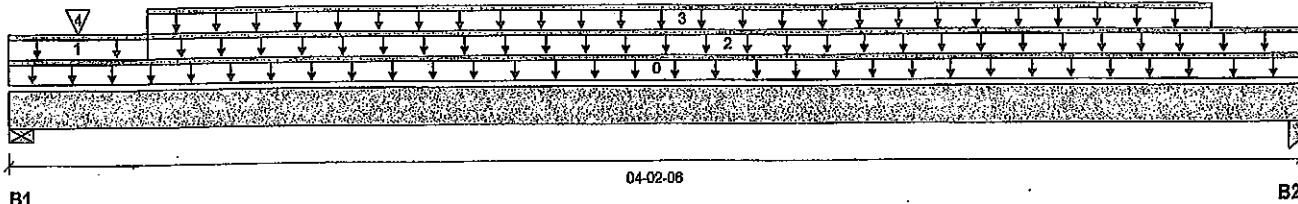

Total Horizontal Product Length = 04-02-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/2"	32 / 0	188 / 0		
B2, 3-1/2"	19 / 0	123 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	04-02-08	Top	1.00	0.65	1.00	1.15	00-00-00
1	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	00-05-08	Top	8				n/a
2	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-05-08	04-02-06	Top	9	5			n/a
3	WALL	Unf. Lin. (lb/ft)	L	00-05-08	03-10-14	Top		60			n/a
4	10(i544)	Conc. Pt. (lbs)	L	00-02-12	00-02-12	Top	12	64			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	155 ft-lbs	7546 ft-lbs	2.1%	0	02-02-03
End Shear	91 lbs	3761 lbs	2.4%	0	01-03-00
Total Load Deflection	L/999 (0.001")	n/a	n/a	4	02-02-03
Live Load Deflection	L/999 (0")	n/a	n/a	5	02-02-03
Max Defl.	0.001"	n/a	n/a	4	02-02-03
Span / Depth	4.6				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 5-1/2" x 1-3/4"	263 lbs	6.8%	3.4%	Spruce-Pine-Fir
B2	Column 3-1/2" x 1-3/4"	172 lbs	6.6%	3.5%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.


Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALCO® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO UBC 2012**AMENDED 2020****BWG NO. TAN 6067-20****STRUCTURAL
COMPONENT ONLY****Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALCO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP 1ST FLR FRAMING\Flush Beams\B4(1440) (Flush Beam)


PASSED

BC CALC® Member Report
Build 7239
Job name:
Address:
City, Province, Postal Code:
Customer:
Code reports: CCMC 12472-R

Dry | 1 span | No cant.

February 7, 2020 09:30:29

File name: MOUNTAINASH 5 EL 1.mmdl
Description: 1ST FLR FRAMING\Flush Beams\B4(1440)
Specifier:
Designer:
Company:

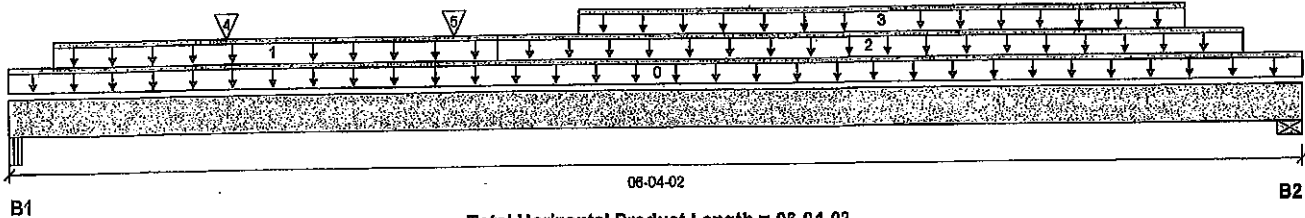

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/4"	1442 / 0	799 / 0		
B2, 3-1/2"	1552 / 0	826 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	06-04-02	Top	1.00	0.65	1.00	1.15	00-00-00
1	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-02-10	02-04-10	Top	26	13			n/a
2	STAIR	Unf. Lin. (lb/ft)	L	02-04-10	06-00-10	Top	240	120			n/a
3	Smoothed Load	Unf. Lin. (lb/ft)	L	02-09-06	05-09-06	Top	341	170			n/a
4	J1(1486)	Conc. Pt. (lbs)	L	01-00-14	01-00-14	Top	316	158			n/a
5	-	Conc. Pt. (lbs)	L	02-02-01	02-02-01	Top	695	415			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	5363 ft-lbs	23220 ft-lbs	23.1%	1	03-03-06
End Shear	2948 lbs	11571 lbs	25.5%	1	01-02-12
Total Load Deflection	L/999 (0.044")	n/a	n/a	4	03-03-06
Live Load Deflection	L/999 (0.029")	n/a	n/a	5	03-03-06
Max Defl.	0.044"	n/a	n/a	4	03-03-06
Span / Depth	7.2				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Beam	5-1/4" x 3-1/2"	3161 lbs	40.3%	14.1%	Unspecified
B2 Wall/Plate	3-1/2" x 3-1/2"	3380 lbs	44.6%	22.5%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
Design meets Code minimum (L/360) Live load deflection criteria.
Calculations assume member is fully braced.
Resistance Factor phi has been applied to all presented results per CSA O86. **AMENDED 2020**
BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.
Design based on Dry Service Condition.
Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 8" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS





NO. 6068-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCi®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,





Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP
1ST FLR FRAMING\Flush Beams\B5(1548) (Flush Beam)

PASSED

BC CALC® Member Report

Dry | 1 span | No cant.

February 7, 2020 09:30:29

Build 7239

Job name:

File name: MOUNTAINASH 5 EL 1.mmdl

Address:

Description: 1ST FLR FRAMING\Flush Beams\B5(1548)

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

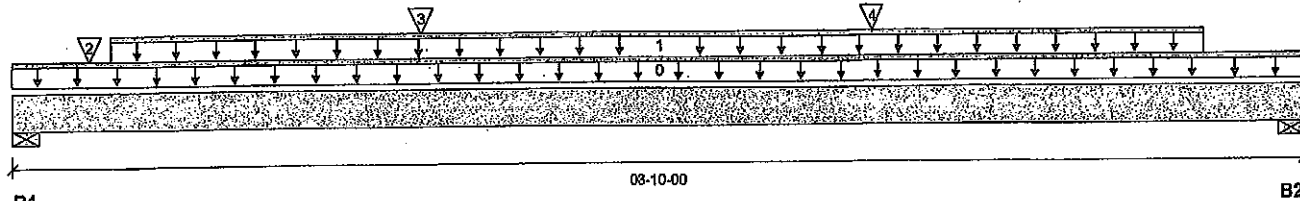

Total Horizontal Product Length = 03-10-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	1050 / 0	535 / 0		
B2, 3-1/2"	766 / 0	392 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	03-10-00	Top	5				00-00-00
1	STAIR	Unf. Lin. (lb/ft)	L	00-03-08	03-06-08	Top	240	120			n/a
2	J2(11488)	Conc. Pt. (lbs)	L	00-02-12	00-02-12	Top	289	145			n/a
3	J2(11439)	Conc. Pt. (lbs)	L	01-02-08	01-02-08	Top	341	171			n/a
4	J2(11540)	Conc. Pt. (lbs)	L	02-06-08	02-06-08	Top	403	201			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1549 ft-lbs	11610 ft-lbs	13.3%	1	02-00-08
End Shear	1228 lbs	5785 lbs	21.2%	1	02-09-00
Total Load Deflection	L/999 (0.009")	n/a	n/a	4	01-11-00
Live Load Deflection	L/999 (0.006")	n/a	n/a	5	01-11-00
Max Defl.	0.009"	n/a	n/a	4	01-11-00
Span / Depth	4.3				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 3-1/2" x 1-3/4"	2244 lbs	59.6%	30.0%	Spruce-Pine-Fir
B2	Wall/Plate 3-1/2" x 1-3/4"	1639 lbs	43.5%	21.9%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



OWN NO. YAM 6069-20
STRUCTURAL COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP
2ND FLR FRAMING\Dropped Beams\B7 DR(1989) (Dropped Beam)

PASSED

BC CALC® Member Report

Dry | 1 span | No cant.

February 7, 2020 09:30:29

Build 7239

Job name:

File name: MOUNTAINASH 5 EL 1.mmdl

Address:

Description: 2ND FLR FRAMING\Dropped Beams\B7 DR(1989)

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

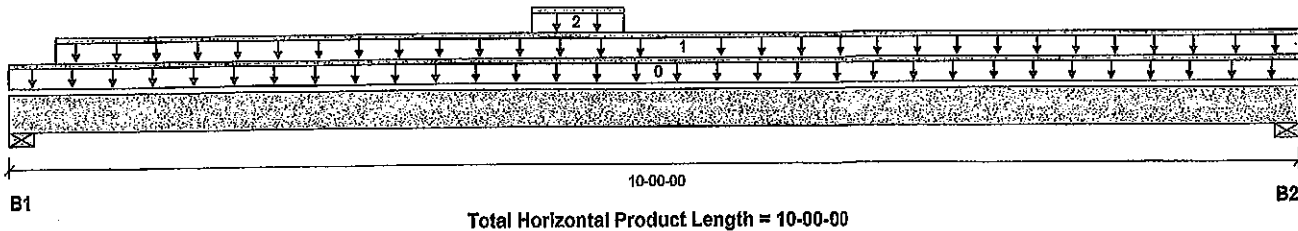

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 4"	1592 / 0	868 / 0		
B2, 4"	1824 / 0	984 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	10-00-00	Top	1.00	0.65	1.00	1.15	00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-04-08	10-00-00	Top	341	170			n/a
2	Bk2(1151)	Unf. Lin. (lb/ft)	L	04-00-04	04-08-12	Top	136	68			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	8666 ft-lbs	36222 ft-lbs	23.9%	1	04-10-08
End Shear	3250 lbs	17356 lbs	18.7%	1	08-10-08
Total Load Deflection	L/875 (0.13")	n/a	27.4%	4	05-00-00
Live Load Deflection	L/999 (0.084")	n/a	n/a	5	05-00-00
Max Defl.	0.13"	n/a	n/a	4	05-00-00
Span / Depth	11.9				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 4" x 5-1/4"	3474 lbs	12.4%	13.6%	Spruce-Pine-Fir
B2	Wall/Plate 4" x 5-1/4"	3967 lbs	14.2%	15.5%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume unbraced length of Top: 00-02-04, Bottom: 00-02-04.


Resistance Factor phi has been applied to all presented results per CSA O86. **AMENDED 2020**

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012



PROVIDE 3 ROWS OF 3/8" ARDOX SPIRAL NAILS @ 12" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS. SPACING NAILS 6" BETWEEN PLYS.



NO. 6070-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC1®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

2ND FLR FRAMING\Flush Beams\B10(1567) (Flush Beam)

PASSED


BC CALC® Member Report
Build 7239
Job name:
Address:
City, Province, Postal Code:
Customer:
Code reports:

Dry | 1 span | No cant.

February 7, 2020 09:30:29

File name: MOUNTAINASH 5 EL 1.mmdl
Description: 2ND FLR FRAMING\Flush Beams\B10(1567)
Specifier:
Designer:
Company:

CCMC 12472-R

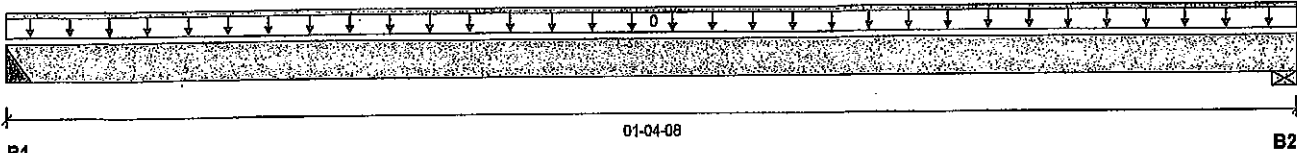

Total Horizontal Product Length = 01-04-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 4"		6 / 0		
B2, 6-1/2"		8 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	01-04-08	Top	1.00	0.65	1.00	1.15	00-00-00

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1 ft-lbs	15093 ft-lbs	n/a	0	00-07-00
End Shear	3 lbs	7521 lbs	n/a	0	00-04-00
Span / Depth	0.8				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Hanger 4" x 3-1/2"	8 lbs	n/a	n/a	HGUS410
B2	Wall/Plate 6-1/2" x 3-1/2"	11 lbs	0.1%	n/a	Spruce-Pine-Fir

Cautions


Header for the hanger HGUS410 at B1 is a Double 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF. Hanger model HGUS410 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

Notes

Calculations assume member is fully braced.
Hanger Manufacturer: Unassigned
Resistance Factor phi has been applied to all presented results per CSA O86.
BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.
Design based on Dry Service Condition.
Importance Factor : Normal Part code : Part 9

CONFORMS TO CBC 2012

AMENDED 2020



PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 6" O/C FOR MULTI-PLY NAILING, MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS



HWB NO. TAM 6071 -20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B13(i625) (Flush Beam)**

Dry | 1 span | No cant.

February 7, 2020 09:30:29

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 5 EL 1.mmd\

Description: 2ND FLR FRAMING\Flush Beams\B13(i625)

Specifier:

Designer:

Company:

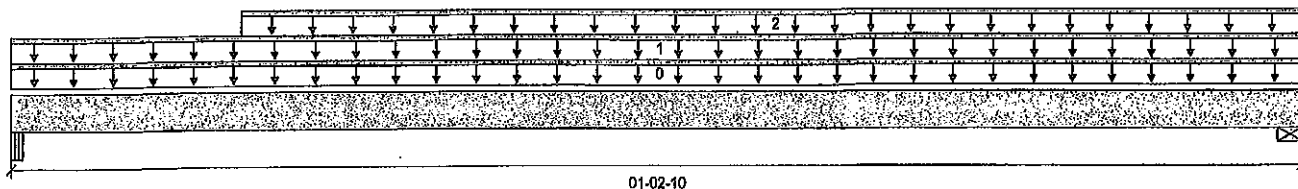

Total Horizontal Product Length = 01-02-10

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2-5/8"	42 / 0	41 / 0	72 / 0	
B2, 5-1/2"	66 / 0	63 / 0	107 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	01-02-10	Top	1.00	0.65	1.00	1.15	00-00-00
1	ROOF	Unf. Lin. (lb/ft)	L	00-00-00	01-02-10	Top	77	70	147		n/a
2	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-02-10	01-02-10	Top	14	7			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	23 ft-lbs	23220 ft-lbs	0.1%	13	00-05-14
End Shear	114 lbs	11571 lbs	1.0%	13	00-02-10
Span / Depth	0.8				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Beam	2-5/8" x 3-1/2"	201 lbs	5.1%	1.8%	Unspecified
B2 Wall/Plate	5-1/2" x 3-1/2"	306 lbs	2.6%	1.3%	Spruce-Pine-Fir

Notes

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.


Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



PROVIDE 3 ROWS OF 3 1/2" ARDOX SPIRAL NAILS @ 4" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS



BWC NO. TAM 6022-20

STRUCTURAL


COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA).

Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®.



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLR FRAMING\Flush Beams\B6(I1574) (Flush Beam)

Dry | 1 span | No cant.

February 7, 2020 09:30:29

BC CALC® Member Report

Bulld 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 5 EL 1.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B6(I1574)

Specifier:

Designer:

Company:

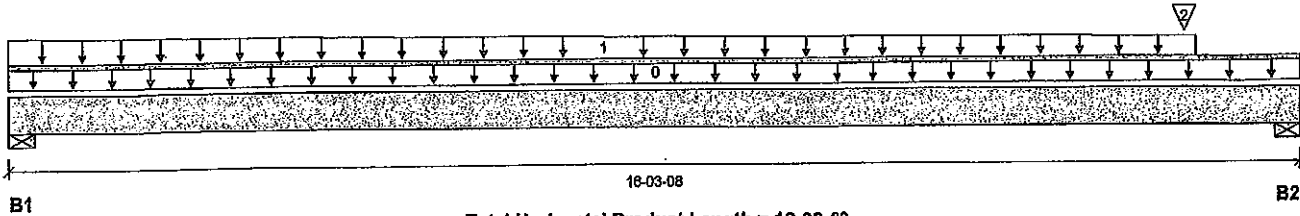

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/2"	332 / 0	247 / 0		
B2, 5-1/2"	1753 / 0	999 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	16-03-08	Top	1.00	0.65	1.00	1.15	00-00-00
1	FC2 Floor Material	Trapezoidal (lb/ft)	L	00-00-00	15-00-00	Top	29	15			n/a
2	B9(I1577)	Conc. Pt. (lbs)	L	14-10-04	14-10-04	Top	23	11			n/a
							1686	890			

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	4312 ft-lbs	23220 ft-lbs	18.6%	1	11-08-00
End Shear	3844 lbs	11571 lbs	33.2%	1	15-00-08
Total Load Deflection	L/703 (0.265")	n/a	34.1%	4	08-08-04
Live Load Deflection	L/1176 (0.158")	n/a	30.6%	5	08-08-04
Max Defl.	0.265"	n/a	n/a	4	08-08-04
Span / Depth	19.6				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 5-1/2" x 3-1/2"	807 lbs	6.8%	3.4%	Spruce-Pine-Fir
B2	Wall/Plate 5-1/2" x 3-1/2"	3877 lbs	32.7%	16.5%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.


Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

AMENDED 2020



PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 12" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS

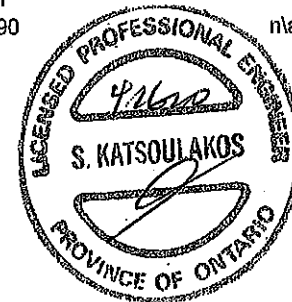

OWB NO. TAM 6073-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA).

Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP
2ND FLR FRAMING\Flush Beams\B8(11569) (Flush Beam)

PASSED

Dry | 1 span | No cant.

February 7, 2020 09:30:29

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports: CCMC 12472-R


File name: MOUNTAINASH 5 EL. 1.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B8(11569)

Specifier:

Designer:

Company:

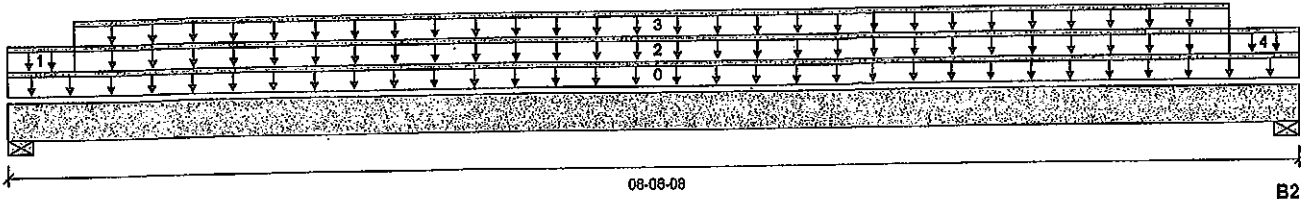

Total Horizontal Product Length = 08-08-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/2"	32 / 0	265 / 0		
B2, 5-1/2"	30 / 0	264 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	08-08-08	Top		5			00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	00-05-08	Top	10				n/a
2	WALL	Unf. Lin. (lb/ft)	L	00-05-08	08-01-00	Top		60			n/a
3	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-05-08	08-01-00	Top	7	4			n/a
4	FC2 Floor Material	Unf. Lin. (lb/ft)	L	08-01-00	08-08-08	Top	6				n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/ Resistance	Case	Location
Pos. Moment	718 ft-lbs	7546 ft-lbs	9.5%	0	04-03-04
End Shear	289 lbs	3761 lbs	7.7%	0	01-03-00
Total Load Deflection	L/999 (0.024")	n/a	n/a	4	04-03-04
Live Load Deflection	L/999 (0.002")	n/a	n/a	5	04-03-04
Max Defl.	0.024"	n/a	n/a	4	04-03-04
Span / Depth	9.8				

Bearing Supports	Dim. (LxW)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material
B1	Wall/Plate 5-1/2" x 1-3/4"	371 lbs	9.6%	4.9%	Spruce-Pine-Fir
B2	Wall/Plate 5-1/2" x 1-3/4"	370 lbs	9.6%	4.8%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



HWU NO. TAM 6074-20

**STRUCTURAL
COMMENT ONLY
Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP
2ND FLR FRAMING\Flush Beams\B9(i1577) (Flush Beam)

PASSED

BC CALC® Member Report

Buld 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R

Dry | 1 span | No cant.

February 7, 2020 09:30:29


File name: MOUNTAINASH 5 EL 1.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B9(i1577)

Specifier:

Designer:

Company:

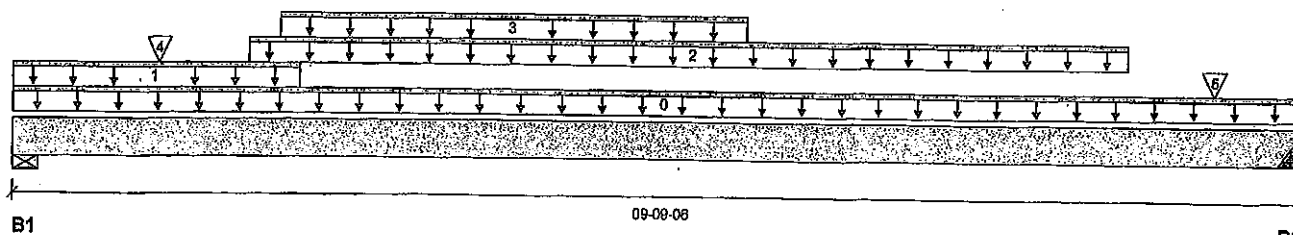

Total Horizontal Product Length = 09-09-06

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2-3/4"	1918 / 0	1008 / 0		
B2, 4"	1730 / 0	914 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	09-09-06	Top	1.00	0.65	1.00	1.15	00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	02-01-14	Top	23	11			n/a
2	Smoothed Load	Unf. Lin. (lb/ft)	L	01-09-04	08-05-04	Top	298	149			n/a
3	STAIR	Unf. Lin. (lb/ft)	L	02-00-01	05-06-01	Top	240	120			n/a
4	J2(i875)	Conc. Pt. (lbs)	L	01-01-04	01-01-04	Top	451	225			n/a
5	J2(i873)	Conc. Pt. (lbs)	L	09-01-04	09-01-04	Top	321	161			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	10250 ft-lbs	23220 ft-lbs	44.1%	1	04-07-04
End Shear	4076 lbs	11571 lbs	35.2%	1	01-00-04
Total Load Deflection	L/501 (0.224")	n/a	47.9%	4	04-09-04
Live Load Deflection	L/763 (0.147")	n/a	47.2%	5	04-09-04
Max Defl.	0.224"	n/a	n/a	4	04-09-04
Span / Depth	11.8				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 2-3/4" x 3-1/2"	4138 lbs	69.9%	35.2%	Spruce-Pine-Fir
B2	Hanger 4" x 3-1/2"	3738 lbs	n/a	21.9%	HGUS410

Cautions

Header for the hanger HGUS410 at B2 is a Double 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF.

Hanger model HGUS410 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.



FWG NO. YAM 6075-20
STRUCTURAL
COMPONENT ONLY



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLR FRAMING\Flush Beams\B9(1577) (Flush Beam)

Dry | 1 span | No cant.

February 7, 2020 09:30:29

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R

File name: MOUNTAINASH 5 EL 1.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B9(1577)

Specifier:

Designer:

Company:

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 8" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS



OWN NO. YAM 6075-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B15(1694) (Flush Beam)**

BC CALC® Member Report

Dry | 2 spans | No cant.

February 7, 2020 10:01:17

Build 7239

Job name:

File name: MOUNTAINASH 5 EL 3.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B15(1694)

City, Province, Postal Code: WATERDOWN

Specifier:


Customer:

Designer: AJ

Code reports:

CCMC 12472-R

Company:

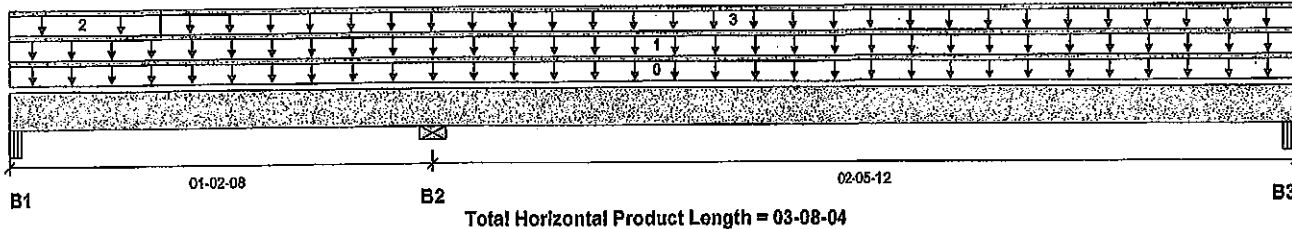**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 5-1/4"	77 / 47	27 / 0	77 / 14	
B2, 5-1/2"	215 / 0	197 / 0	320 / 0	
B3, 5-1/4"	122 / 1	111 / 0	181 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	03-08-04	Top		10			00-00-00
1	ROOF	Unf. Lin. (lb/ft)	L	00-00-00	03-08-04	Top	77	70	147		n/a
2	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	00-05-04	Top	27	13			n/a
3	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-05-04	03-08-04	Top	22	11			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	159 ft-lbs	23220 ft-lbs	0.7%	66	02-05-08
Neg. Moment	-182 ft-lbs	-23220 ft-lbs	0.8%	49	01-02-08
End Shear	134 lbs	11571 lbs	1.2%	18	00-05-04
Cont. Shear	299 lbs	11571 lbs	2.6%	67	00-11-12
Total Load Deflection	L/999 (0")	n/a	n/a	126	02-04-05
Live Load Deflection	L/999 (0")	n/a	n/a	178	02-04-05
Max Defl.	0"	n/a	n/a	126	02-04-05
Span / Depth	2.7				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Beam	5-1/4" x 3-1/2"	227 lbs	2.3%	1.0%	Unspecified
B2 Wall/Plate	5-1/2" x 3-1/2"	940 lbs	7.9%	4.0%	Spruce-Pine-Fir
B3 Beam	5-1/4" x 3-1/2"	533 lbs	5.4%	2.4%	Unspecified

Cautions

Uplift of 60 lbs found at bearing B1. (SIMPSON 2-H254 @ G. B1)

DWG NO. TAM 6076-20
STRUCTURAL
COMPONENT ONLY



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP
2ND FLR FRAMING\Flush Beams\B15(I1694) (Flush Beam)

PASSED

February 7, 2020 10:01:17

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code: WATERDOWN

Customer:

Code reports: CCMC 12472-R

File name: MOUNTAINASH 5 EL 3.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B15(I1694)

Specifier:

Designer: AJ

Company:

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.


Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



PROVIDE 3 ROWS OF 3/4" ARDOX
SPIRAL NAILS @ 8" O/C FOR
MULTI-PLY NAILING. MAINTAIN
A MIN. 2" LUMBER EDGE/END
DISTANCE. DO NOT USE AIR NAILS



DWG NO. YAW 6076-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of Input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before Installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCi®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

1ST FLR FRAMING\Flush Beams\B1A(1996) (Flush Beam)

PASSED

BC CALC® Member Report

Dry | 1 span | No cant.

April 16, 2020 08:25:38

Build 7239

Job name:

File name: MOUNTAINASH 5 EL 1 DECK CONDITION.mmdl

Address:

Description: 1ST FLR FRAMING\Flush Beams\B1A(1996)

City, Province, Postal Code: WATERDOWN


Specifier:

Customer:

Designer: AJ

Code reports: CCMC 12472-R

Company:

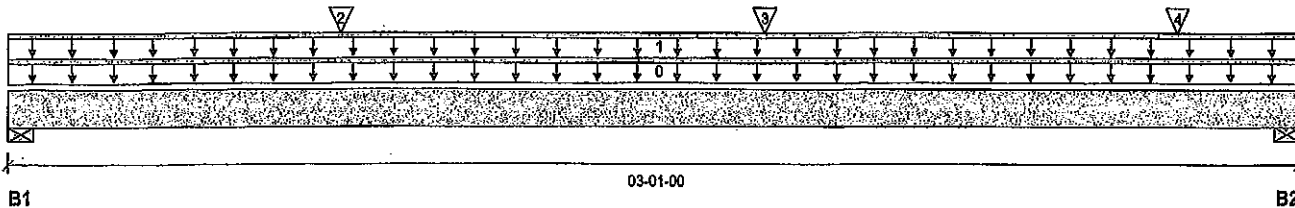

Total Horizontal Product Length = 03-01-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3"	923 / 0	601 / 0		
B2, 3"	1134 / 0	706 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	03-01-00	Top		10			00-00-00
1	E1(i402)	Unf. Lin. (lb/ft)	L	00-00-00	03-01-00	Top	337	250			n/a
2	J1(i1927)	Conc. Pt. (lbs)	L	00-09-08	00-09-08	Top	339	169			n/a
3	J1(i1877)	Conc. Pt. (lbs)	L	01-09-08	01-09-08	Top	339	169			n/a
4	J1(i1942)	Conc. Pt. (lbs)	L	02-09-08	02-09-08	Top	339	169			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1386 ft-lbs	23220 ft-lbs	6.0%	1	01-08-06
End Shear	1690 lbs	11571 lbs	14.6%	1	01-00-08
Total Load Deflection	L/999 (0.003")	n/a	n/a	4	01-06-11
Live Load Deflection	L/999 (0.002")	n/a	n/a	5	01-06-11
Max Defl.	0.003"	n/a	n/a	4	01-06-11
Span / Depth	3.4				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 3" x 3-1/2"	2135 lbs	33.1%	16.7%	Spruce-Pine-Fir
B2	Wall/Plate 3" x 3-1/2"	2583 lbs	40.0%	20.2%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.


Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

AMENDED 2020



PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 8" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS




UWH NO. TAM 6077-20

STRUCTURAL COMPONENT ONLY Disclosure

Use of the Bolsa Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Bolsa Cascade engineered wood products must be in accordance with current installation Guide and applicable building codes. To obtain installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®.





Maximum Floor Spans

Live Load = 40 psf, Dead Load = 30 psf
Simple Spans, L/480 Deflection Limit
3/4" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-2"	13'-4"	12'-4"	15'-7"	14'-2"	13'-4"	12'-4"
	NI-40x	17'-0"	16'-0"	15'-1"	13'-11"	17'-5"	16'-1"	15'-1"	13'-11"
	NI-60	17'-2"	16'-2"	15'-5"	14'-3"	17'-6"	16'-5"	15'-5"	14'-3"
	NI-70	18'-0"	16'-11"	16'-3"	15'-6"	18'-5"	17'-3"	16'-7"	15'-6"
	NI-80	18'-3"	17'-1"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	15'-10"
11-7/8"	NI-20	17'-10"	16'-10"	16'-0"	14'-10"	18'-6"	17'-1"	16'-0"	14'-10"
	NI-40x	19'-4"	17'-11"	17'-3"	15'-10"	19'-11"	18'-6"	17'-9"	15'-10"
	NI-60	19'-7"	18'-2"	17'-5"	16'-9"	20'-2"	18'-9"	17'-11"	17'-1"
	NI-70	20'-9"	19'-2"	18'-3"	17'-5"	21'-4"	19'-9"	18'-10"	17'-10"
	NI-80	21'-1"	19'-5"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
14"	NI-90x	21'-8"	20'-0"	19'-1"	18'-0"	22'-2"	20'-6"	19'-6"	18'-6"
	NI-40x	21'-5"	19'-10"	18'-11"	17'-5"	22'-1"	20'-6"	19'-6"	17'-5"
	NI-60	21'-10"	20'-2"	19'-3"	18'-2"	22'-5"	20'-10"	19'-11"	18'-10"
	NI-70	23'-0"	21'-3"	20'-3"	19'-2"	23'-8"	21'-11"	20'-10"	19'-9"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
16"	NI-90x	24'-1"	22'-3"	21'-2"	20'-0"	24'-8"	22'-10"	21'-9"	20'-7"
	NI-60	23'-9"	22'-0"	20'-11"	19'-10"	24'-6"	22'-9"	21'-8"	20'-6"
	NI-70	25'-1"	23'-2"	22'-0"	20'-10"	25'-9"	23'-10"	22'-9"	21'-6"
	NI-80	25'-6"	23'-6"	22'-4"	21'-2"	26'-1"	24'-2"	23'-1"	21'-10"
	NI-90x	26'-4"	24'-3"	23'-1"	21'-10"	26'-11"	24'-11"	23'-8"	22'-5"

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-2"	13'-4"	12'-4"	15'-7"	14'-2"	13'-4"	12'-4"
	NI-40x	17'-9"	16'-1"	15'-1"	13'-11"	17'-9"	16'-1"	15'-1"	13'-11"
	NI-60	18'-1"	16'-5"	15'-5"	14'-3"	18'-1"	16'-5"	15'-5"	14'-3"
	NI-70	19'-10"	17'-11"	16'-9"	15'-6"	19'-10"	17'-11"	16'-9"	15'-6"
	NI-80	20'-2"	18'-3"	17'-1"	15'-10"	20'-2"	18'-3"	17'-1"	15'-10"
11-7/8"	NI-20	18'-10"	17'-1"	16'-0"	14'-10"	18'-10"	17'-1"	16'-0"	14'-10"
	NI-40x	21'-3"	19'-3"	17'-9"	15'-10"	21'-3"	19'-3"	17'-9"	15'-10"
	NI-60	21'-9"	19'-8"	18'-5"	17'-1"	21'-9"	19'-8"	18'-5"	17'-1"
	NI-70	23'-4"	21'-5"	20'-1"	18'-6"	23'-8"	21'-5"	20'-1"	18'-6"
	NI-80	23'-7"	21'-10"	20'-5"	18'-11"	24'-1"	21'-10"	20'-5"	18'-11"
14"	NI-90x	24'-3"	22'-6"	21'-3"	19'-7"	24'-8"	22'-7"	21'-3"	19'-7"
	NI-40x	24'-2"	21'-5"	19'-6"	17'-5"	24'-2"	21'-5"	19'-6"	17'-5"
	NI-60	24'-9"	22'-5"	21'-0"	19'-6"	24'-9"	22'-5"	21'-0"	19'-6"
	NI-70	26'-1"	24'-3"	22'-9"	21'-0"	26'-8"	24'-3"	22'-9"	21'-0"
	NI-80	26'-6"	24'-7"	23'-3"	21'-6"	27'-1"	24'-10"	23'-3"	21'-6"
16"	NI-90x	27'-3"	25'-4"	24'-1"	22'-4"	27'-9"	25'-10"	24'-3"	22'-4"
	NI-60	27'-3"	24'-11"	23'-5"	21'-7"	27'-6"	24'-11"	23'-5"	21'-7"
	NI-70	28'-8"	26'-8"	25'-3"	23'-4"	29'-3"	26'-11"	25'-3"	23'-4"
	NI-80	29'-1"	27'-0"	25'-9"	23'-10"	29'-8"	27'-6"	25'-10"	23'-10"
	NI-90x	29'-11"	27'-10"	26'-6"	24'-10"	30'-6"	28'-5"	26'-11"	24'-10"

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.





Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf
Simple spans, L/480 Deflection Limit
5/8" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-2"	13'-9"	N/A	15'-7"	14'-8"	14'-2"	N/A
	NI-40x	16'-1"	15'-2"	14'-8"	N/A	16'-7"	15'-7"	15'-1"	N/A
	NI-60	16'-3"	15'-4"	14'-10"	N/A	16'-8"	15'-9"	15'-3"	N/A
	NI-70	17'-1"	16'-1"	15'-6"	N/A	17'-5"	16'-5"	15'-10"	N/A
	NI-80	17'-3"	16'-3"	15'-8"	N/A	17'-8"	16'-7"	16'-0"	N/A
11-7/8"	NI-20	16'-11"	16'-0"	15'-5"	N/A	17'-6"	16'-6"	16'-0"	N/A
	NI-40x	18'-1"	17'-0"	16'-5"	N/A	18'-9"	17'-6"	16'-11"	N/A
	NI-60	18'-4"	17'-3"	16'-7"	N/A	19'-0"	17'-8"	17'-1"	N/A
	NI-70	19'-6"	18'-0"	17'-4"	N/A	20'-1"	18'-7"	17'-9"	N/A
	NI-80	19'-9"	18'-3"	17'-6"	N/A	20'-4"	18'-10"	17'-11"	N/A
14"	NI-90x	20'-4"	18'-9"	17'-11"	N/A	20'-10"	19'-3"	18'-5"	N/A
	NI-40x	20'-1"	18'-7"	17'-10"	N/A	20'-10"	19'-4"	18'-6"	N/A
	NI-60	20'-5"	18'-11"	18'-1"	N/A	21'-2"	19'-7"	18'-9"	N/A
	NI-70	21'-7"	20'-0"	19'-1"	N/A	22'-3"	20'-7"	19'-8"	N/A
	NI-80	21'-11"	20'-3"	19'-4"	N/A	22'-7"	20'-11"	20'-0"	N/A
16"	NI-90x	22'-7"	20'-11"	19'-11"	N/A	23'-3"	21'-6"	20'-6"	N/A
	NI-60	22'-3"	20'-8"	19'-9"	N/A	23'-1"	21'-5"	20'-6"	N/A
	NI-70	23'-6"	21'-9"	20'-9"	N/A	24'-3"	22'-5"	21'-5"	N/A
	NI-80	23'-11"	22'-1"	21'-1"	N/A	24'-8"	22'-10"	21'-9"	N/A
	NI-90x	24'-8"	22'-9"	21'-9"	N/A	25'-4"	23'-5"	22'-4"	N/A
Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-8"	15'-3"	14'-5"	N/A	16'-8"	15'-3"	14'-5"	N/A
	NI-40x	17'-11"	16'-11"	16'-1"	N/A	18'-5"	17'-1"	16'-1"	N/A
	NI-60	18'-2"	17'-1"	16'-4"	N/A	18'-7"	17'-4"	16'-4"	N/A
	NI-70	19'-2"	17'-10"	17'-2"	N/A	19'-7"	18'-3"	17'-7"	N/A
	NI-80	19'-5"	18'-0"	17'-4"	N/A	19'-10"	18'-5"	17'-8"	N/A
11-7/8"	NI-20	19'-6"	18'-1"	17'-3"	N/A	19'-11"	18'-3"	17'-3"	N/A
	NI-40x	21'-0"	19'-6"	18'-8"	N/A	21'-7"	20'-2"	19'-2"	N/A
	NI-60	21'-4"	19'-9"	18'-11"	N/A	21'-11"	20'-4"	19'-6"	N/A
	NI-70	22'-6"	20'-10"	19'-11"	N/A	23'-0"	21'-5"	20'-5"	N/A
	NI-80	22'-9"	21'-1"	20'-1"	N/A	23'-3"	21'-7"	20'-8"	N/A
14"	NI-90x	23'-4"	21'-8"	20'-8"	N/A	23'-10"	22'-2"	21'-2"	N/A
	NI-40x	23'-7"	21'-11"	20'-11"	N/A	24'-3"	22'-7"	21'-7"	N/A
	NI-60	24'-0"	22'-3"	21'-3"	N/A	24'-8"	22'-11"	21'-11"	N/A
	NI-70	25'-3"	23'-4"	22'-3"	N/A	25'-10"	24'-0"	22'-11"	N/A
	NI-80	25'-7"	23'-8"	22'-7"	N/A	26'-2"	24'-4"	23'-2"	N/A
16"	NI-90x	26'-4"	24'-4"	23'-3"	N/A	26'-10"	24'-11"	23'-9"	N/A
	NI-60	26'-5"	24'-6"	23'-4"	N/A	27'-2"	25'-3"	24'-2"	N/A
	NI-70	27'-9"	25'-8"	24'-6"	N/A	28'-5"	26'-5"	25'-2"	N/A
	NI-80	28'-2"	26'-1"	24'-10"	N/A	28'-10"	26'-9"	25'-6"	N/A
	NI-90x	29'-0"	26'-10"	25'-7"	N/A	29'-7"	27'-5"	26'-2"	N/A

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-1274C.



Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf.
Simple Spans, L/480 Deflection Limit
3/4" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-10"	15'-0"	14'-5"	13'-5"	16'-4"	15'-5"	14'-6"	13'-5"
	NI-40x	17'-0"	16'-0"	15'-5"	14'-9"	17'-5"	16'-5"	15'-10"	15'-2"
	NI-60	17'-2"	16'-2"	15'-7"	14'-11"	17'-6"	16'-7"	15'-11"	15'-3"
	NI-70	18'-0"	16'-11"	16'-3"	15'-7"	18'-5"	17'-3"	16'-7"	15'-11"
	NI-80	18'-3"	17'-1"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	16'-1"
11-7/8"	NI-20	17'-10"	16'-10"	16'-2"	15'-6"	18'-6"	17'-4"	16'-9"	16'-1"
	NI-40x	19'-4"	17'-11"	17'-3"	16'-6"	19'-11"	18'-6"	17'-9"	17'-0"
	NI-60	19'-7"	18'-2"	17'-5"	16'-9"	20'-2"	18'-9"	17'-11"	17'-2"
	NI-70	20'-9"	19'-2"	18'-3"	17'-5"	21'-4"	19'-9"	18'-10"	17'-10"
	NI-80	21'-1"	19'-5"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
14"	NI-90x	21'-8"	20'-0"	19'-1"	18'-0"	22'-2"	20'-8"	19'-6"	18'-6"
	NI-40x	21'-5"	19'-10"	18'-11"	17'-11"	22'-1"	20'-6"	19'-7"	18'-7"
	NI-60	21'-10"	20'-2"	19'-3"	18'-2"	22'-5"	20'-10"	19'-11"	18'-10"
	NI-70	23'-0"	21'-3"	20'-3"	19'-2"	23'-8"	21'-11"	20'-10"	19'-9"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
16"	NI-90x	24'-1"	22'-3"	21'-2"	20'-0"	24'-8"	22'-10"	21'-9"	20'-7"
	NI-60	23'-9"	22'-0"	20'-11"	19'-10"	24'-6"	22'-9"	21'-8"	20'-6"
	NI-70	25'-1"	23'-2"	22'-0"	20'-10"	25'-9"	23'-10"	22'-9"	21'-6"
	NI-80	25'-6"	23'-6"	22'-4"	21'-2"	26'-1"	24'-2"	23'-1"	21'-10"
	NI-90x	26'-4"	24'-3"	23'-1"	21'-10"	26'-11"	24'-11"	23'-8"	22'-5"

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-10"	15'-5"	14'-6"	13'-5"	16'-10"	15'-5"	14'-6"	13'-5"
	NI-40x	18'-8"	17'-2"	16'-3"	15'-2"	18'-10"	17'-2"	16'-3"	15'-2"
	NI-60	18'-11"	17'-6"	16'-6"	15'-5"	19'-2"	17'-6"	16'-6"	15'-5"
	NI-70	20'-0"	18'-7"	17'-9"	16'-7"	20'-5"	18'-11"	17'-10"	16'-7"
	NI-80	20'-3"	18'-10"	17'-11"	16'-10"	20'-8"	19'-3"	18'-2"	16'-10"
11-7/8"	NI-20	20'-1"	18'-5"	17'-5"	16'-2"	20'-1"	18'-5"	17'-5"	16'-2"
	NI-40x	21'-10"	20'-4"	19'-4"	17'-8"	22'-5"	20'-6"	19'-4"	17'-8"
	NI-60	22'-1"	20'-7"	19'-7"	18'-4"	22'-8"	20'-10"	19'-8"	18'-4"
	NI-70	23'-4"	21'-8"	20'-8"	19'-7"	23'-10"	22'-3"	21'-2"	19'-9"
	NI-80	23'-7"	21'-11"	20'-11"	19'-9"	24'-1"	22'-6"	21'-5"	20'-0"
14"	NI-90x	24'-3"	22'-6"	21'-6"	20'-4"	24'-8"	23'-0"	22'-0"	20'-9"
	NI-40x	24'-5"	22'-9"	21'-8"	19'-5"	25'-1"	23'-2"	21'-9"	19'-5"
	NI-60	24'-10"	23'-1"	22'-0"	20'-10"	25'-6"	23'-8"	22'-4"	20'-10"
	NI-70	26'-1"	24'-3"	23'-2"	21'-10"	26'-8"	24'-11"	23'-9"	22'-4"
	NI-80	26'-6"	24'-7"	23'-5"	22'-2"	27'-1"	25'-3"	24'-1"	22'-9"
16"	NI-90x	27'-3"	25'-4"	24'-1"	22'-9"	27'-9"	25'-11"	24'-8"	23'-4"
	NI-60	27'-3"	25'-5"	24'-2"	22'-10"	28'-0"	26'-2"	24'-9"	23'-1"
	NI-70	28'-8"	26'-8"	25'-4"	23'-11"	29'-3"	27'-4"	26'-1"	24'-8"
	NI-80	29'-1"	27'-0"	25'-9"	24'-4"	29'-8"	27'-9"	26'-5"	25'-0"
	NI-90x	29'-11"	27'-10"	26'-6"	25'-0"	30'-6"	28'-5"	27'-2"	25'-8"


- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.

Maximum Floor Spans

Live Load = 40 psf, Dead Load = 30 psf

Simple Spans, L/480 Deflection Limit

5/8" OSB G&N Sheathing





Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-1"	13'-3"	N/A	15'-7"	14'-1"	13'-3"	N/A
	NI-40x	16'-1"	15'-2"	14'-8"	N/A	16'-7"	15'-7"	15'-1"	N/A
	NI-60	16'-3"	15'-4"	14'-10"	N/A	16'-8"	15'-9"	15'-3"	N/A
	NI-70	17'-1"	16'-1"	15'-6"	N/A	17'-5"	16'-5"	15'-10"	N/A
	NI-80	17'-3"	16'-3"	15'-8"	N/A	17'-8"	16'-7"	16'-0"	N/A
11-7/8"	NI-20	16'-11"	16'-0"	15'-5"	N/A	17'-6"	16'-6"	16'-0"	N/A
	NI-40x	18'-1"	17'-0"	16'-5"	N/A	18'-9"	17'-6"	16'-11"	N/A
	NI-60	18'-4"	17'-3"	16'-7"	N/A	19'-0"	17'-8"	17'-1"	N/A
	NI-70	19'-6"	18'-0"	17'-4"	N/A	20'-1"	18'-7"	17'-9"	N/A
	NI-80	19'-9"	18'-3"	17'-6"	N/A	20'-4"	18'-10"	17'-11"	N/A
14"	NI-90x	20'-4"	18'-9"	17'-11"	N/A	20'-10"	19'-3"	18'-5"	N/A
	NI-40x	20'-1"	18'-7"	17'-10"	N/A	20'-10"	19'-4"	18'-6"	N/A
	NI-60	20'-5"	18'-11"	18'-1"	N/A	21'-2"	19'-7"	18'-9"	N/A
	NI-70	21'-7"	20'-0"	19'-1"	N/A	22'-3"	20'-7"	19'-8"	N/A
	NI-80	21'-11"	20'-3"	19'-4"	N/A	22'-7"	20'-11"	20'-0"	N/A
16"	NI-90x	22'-7"	20'-11"	19'-11"	N/A	23'-3"	21'-6"	20'-6"	N/A
	NI-60	22'-3"	20'-8"	19'-9"	N/A	23'-1"	21'-5"	20'-6"	N/A
	NI-70	23'-6"	21'-9"	20'-9"	N/A	24'-3"	22'-5"	21'-5"	N/A
	NI-80	23'-11"	22'-1"	21'-1"	N/A	24'-8"	22'-10"	21'-9"	N/A
	NI-90x	24'-8"	22'-9"	21'-9"	N/A	25'-4"	23'-5"	22'-4"	N/A

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-1"	13'-3"	N/A	15'-7"	14'-1"	13'-3"	N/A
	NI-40x	17'-9"	16'-1"	15'-1"	N/A	17'-9"	16'-1"	15'-1"	N/A
	NI-60	18'-1"	16'-4"	15'-4"	N/A	18'-1"	16'-4"	15'-4"	N/A
	NI-70	19'-2"	17'-10"	16'-9"	N/A	19'-7"	17'-10"	16'-9"	N/A
	NI-80	19'-5"	18'-0"	17'-1"	N/A	19'-10"	18'-3"	17'-1"	N/A
11-7/8"	NI-20	18'-9"	17'-0"	16'-0"	N/A	18'-9"	17'-0"	16'-0"	N/A
	NI-40x	21'-0"	19'-3"	17'-9"	N/A	21'-3"	19'-3"	17'-9"	N/A
	NI-60	21'-4"	19'-8"	18'-5"	N/A	21'-8"	19'-8"	18'-5"	N/A
	NI-70	22'-6"	20'-10"	19'-11"	N/A	23'-0"	21'-4"	20'-0"	N/A
	NI-80	22'-9"	21'-1"	20'-1"	N/A	23'-3"	21'-7"	20'-5"	N/A
14"	NI-90x	23'-4"	21'-8"	20'-8"	N/A	23'-10"	22'-2"	21'-2"	N/A
	NI-40x	23'-7"	21'-5"	19'-6"	N/A	24'-1"	21'-5"	19'-6"	N/A
	NI-60	24'-0"	22'-3"	21'-0"	N/A	24'-8"	22'-5"	21'-0"	N/A
	NI-70	25'-3"	23'-4"	22'-3"	N/A	25'-10"	24'-0"	22'-9"	N/A
	NI-80	25'-7"	23'-8"	22'-7"	N/A	26'-2"	24'-4"	23'-2"	N/A
16"	NI-90x	26'-4"	24'-4"	23'-3"	N/A	26'-10"	24'-11"	23'-9"	N/A
	NI-60	26'-5"	24'-6"	23'-4"	N/A	27'-2"	24'-10"	23'-4"	N/A
	NI-70	27'-9"	25'-8"	24'-6"	N/A	28'-5"	26'-5"	25'-2"	N/A
	NI-80	28'-2"	26'-1"	24'-10"	N/A	28'-10"	26'-9"	25'-6"	N/A
	NI-90x	29'-0"	26'-10"	25'-7"	N/A	29'-7"	27'-5"	26'-2"	N/A

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.

1w-1

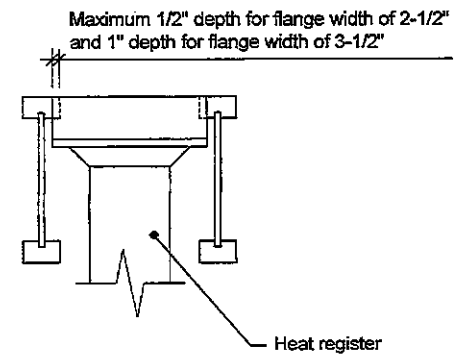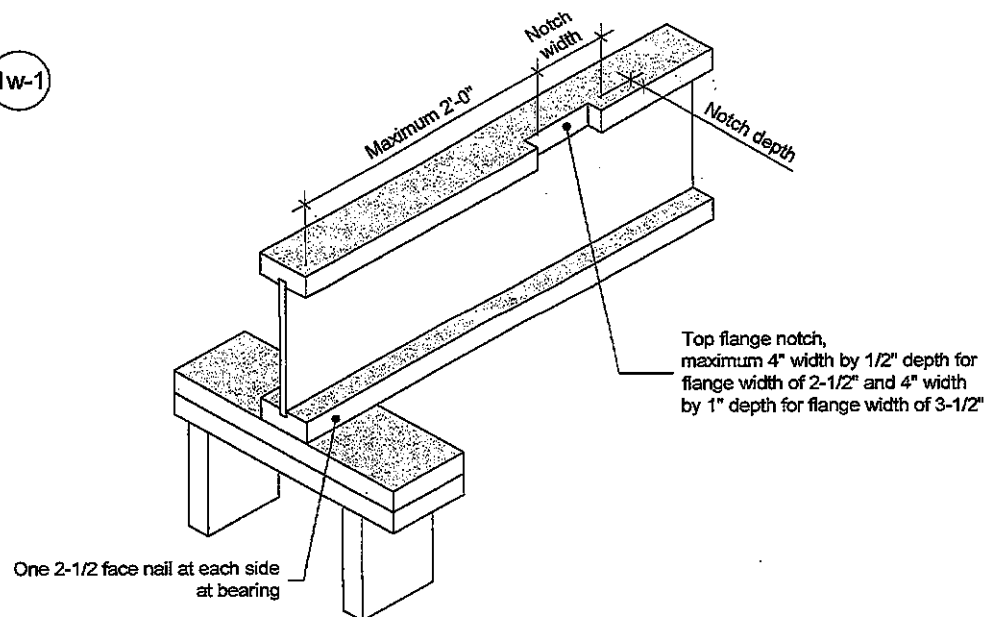

Notes:

1. Blocking required at bearing for lateral support, not shown for clarity.
2. The maximum dimensions for a notch on the side of the top flange are 4-inch width by 1/2-inch depth for flange width of 2-1/2 inches, and 4-inch width by 1-inch depth for flange width of 3-1/2 inches.
3. This detail applies to simple-span joists and multiple-span joists where the notch is located at the end half-span.
4. For other applications, contact Nordic Structures.

This document supersedes all previous versions. If the document has been in effect for more than one year, consult nordic.ca or contact Nordic Structures.

All nails shown in the details are assumed to be common nails unless otherwise noted. Nails shall have a diameter not less than 0.128 inch for 2-1/2-inch nails, or 0.144 inch for 3-inch nails. Individual components not shown to scale for clarity.

NORDIC
STRUCTURES

T 514-871-8526
1 866 817-3419
nordic.ca

TITLE
Notch in I-joist for Heat Register

CATEGORY
I-joist - Typical Floor Framing and Construction Details

DOCUMENT

-

DATE
2018-04-10

NUMBER
1w-1



Construction Detail


Limit States Design

Allowance for Piping (Installation Notes)

The floor layouts have usually not been checked for heating and/or plumbing interference. On-site adjustment of joists of up to 3 inches is permitted to avoid interferences. When moving a joist, the subfloor thickness shall be checked with code requirements when the joist spacing exceeds 19.2 inches. Except for cutting to length, I-joist flanges should never be cut, drilled, or notched.

Installation of Nordic I-joists shall be as per *Nordic Joist Installation Guide for Residential Floors*. Refer to Tables 1 and 2 for maximum web hole and duct chase openings, respectively. These tables are based on the I-joists being used at their maximum spans. The minimum distance given may be reduced for shorter spans; contact your distributor for additional information.

The detail below shows the 3-inch allowance for piping. Every third joist may be shifted up to 3 inches to avoid heating/plumbing interference. For other applications, please contact your distributor.

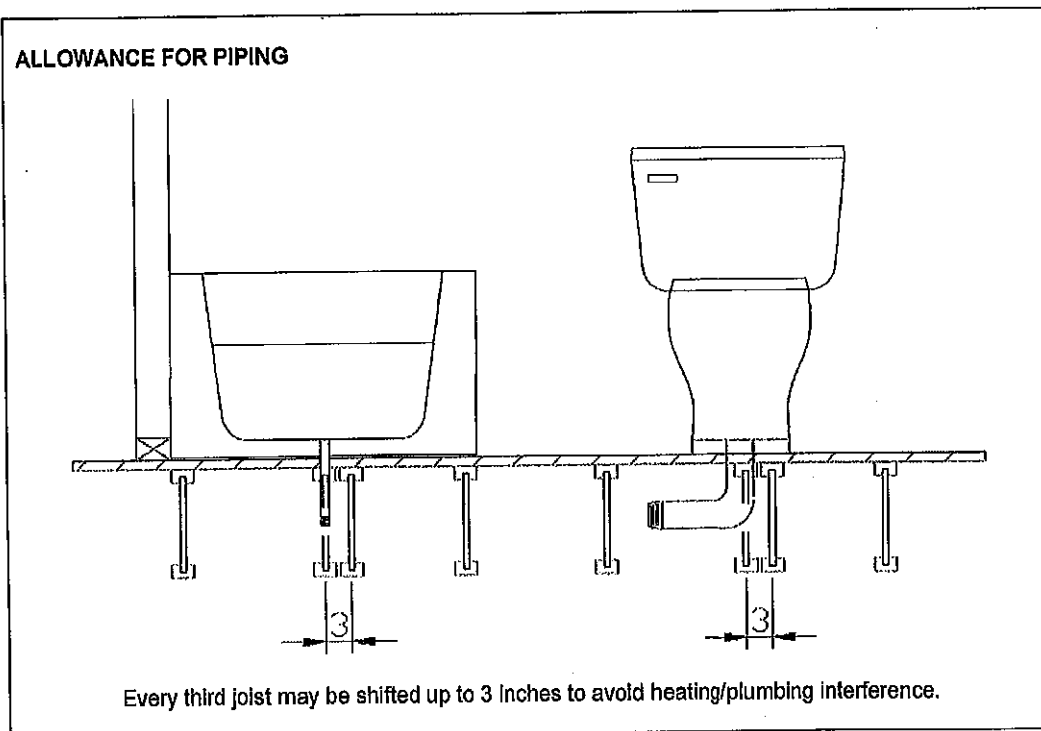

Revised April 12, 2012