



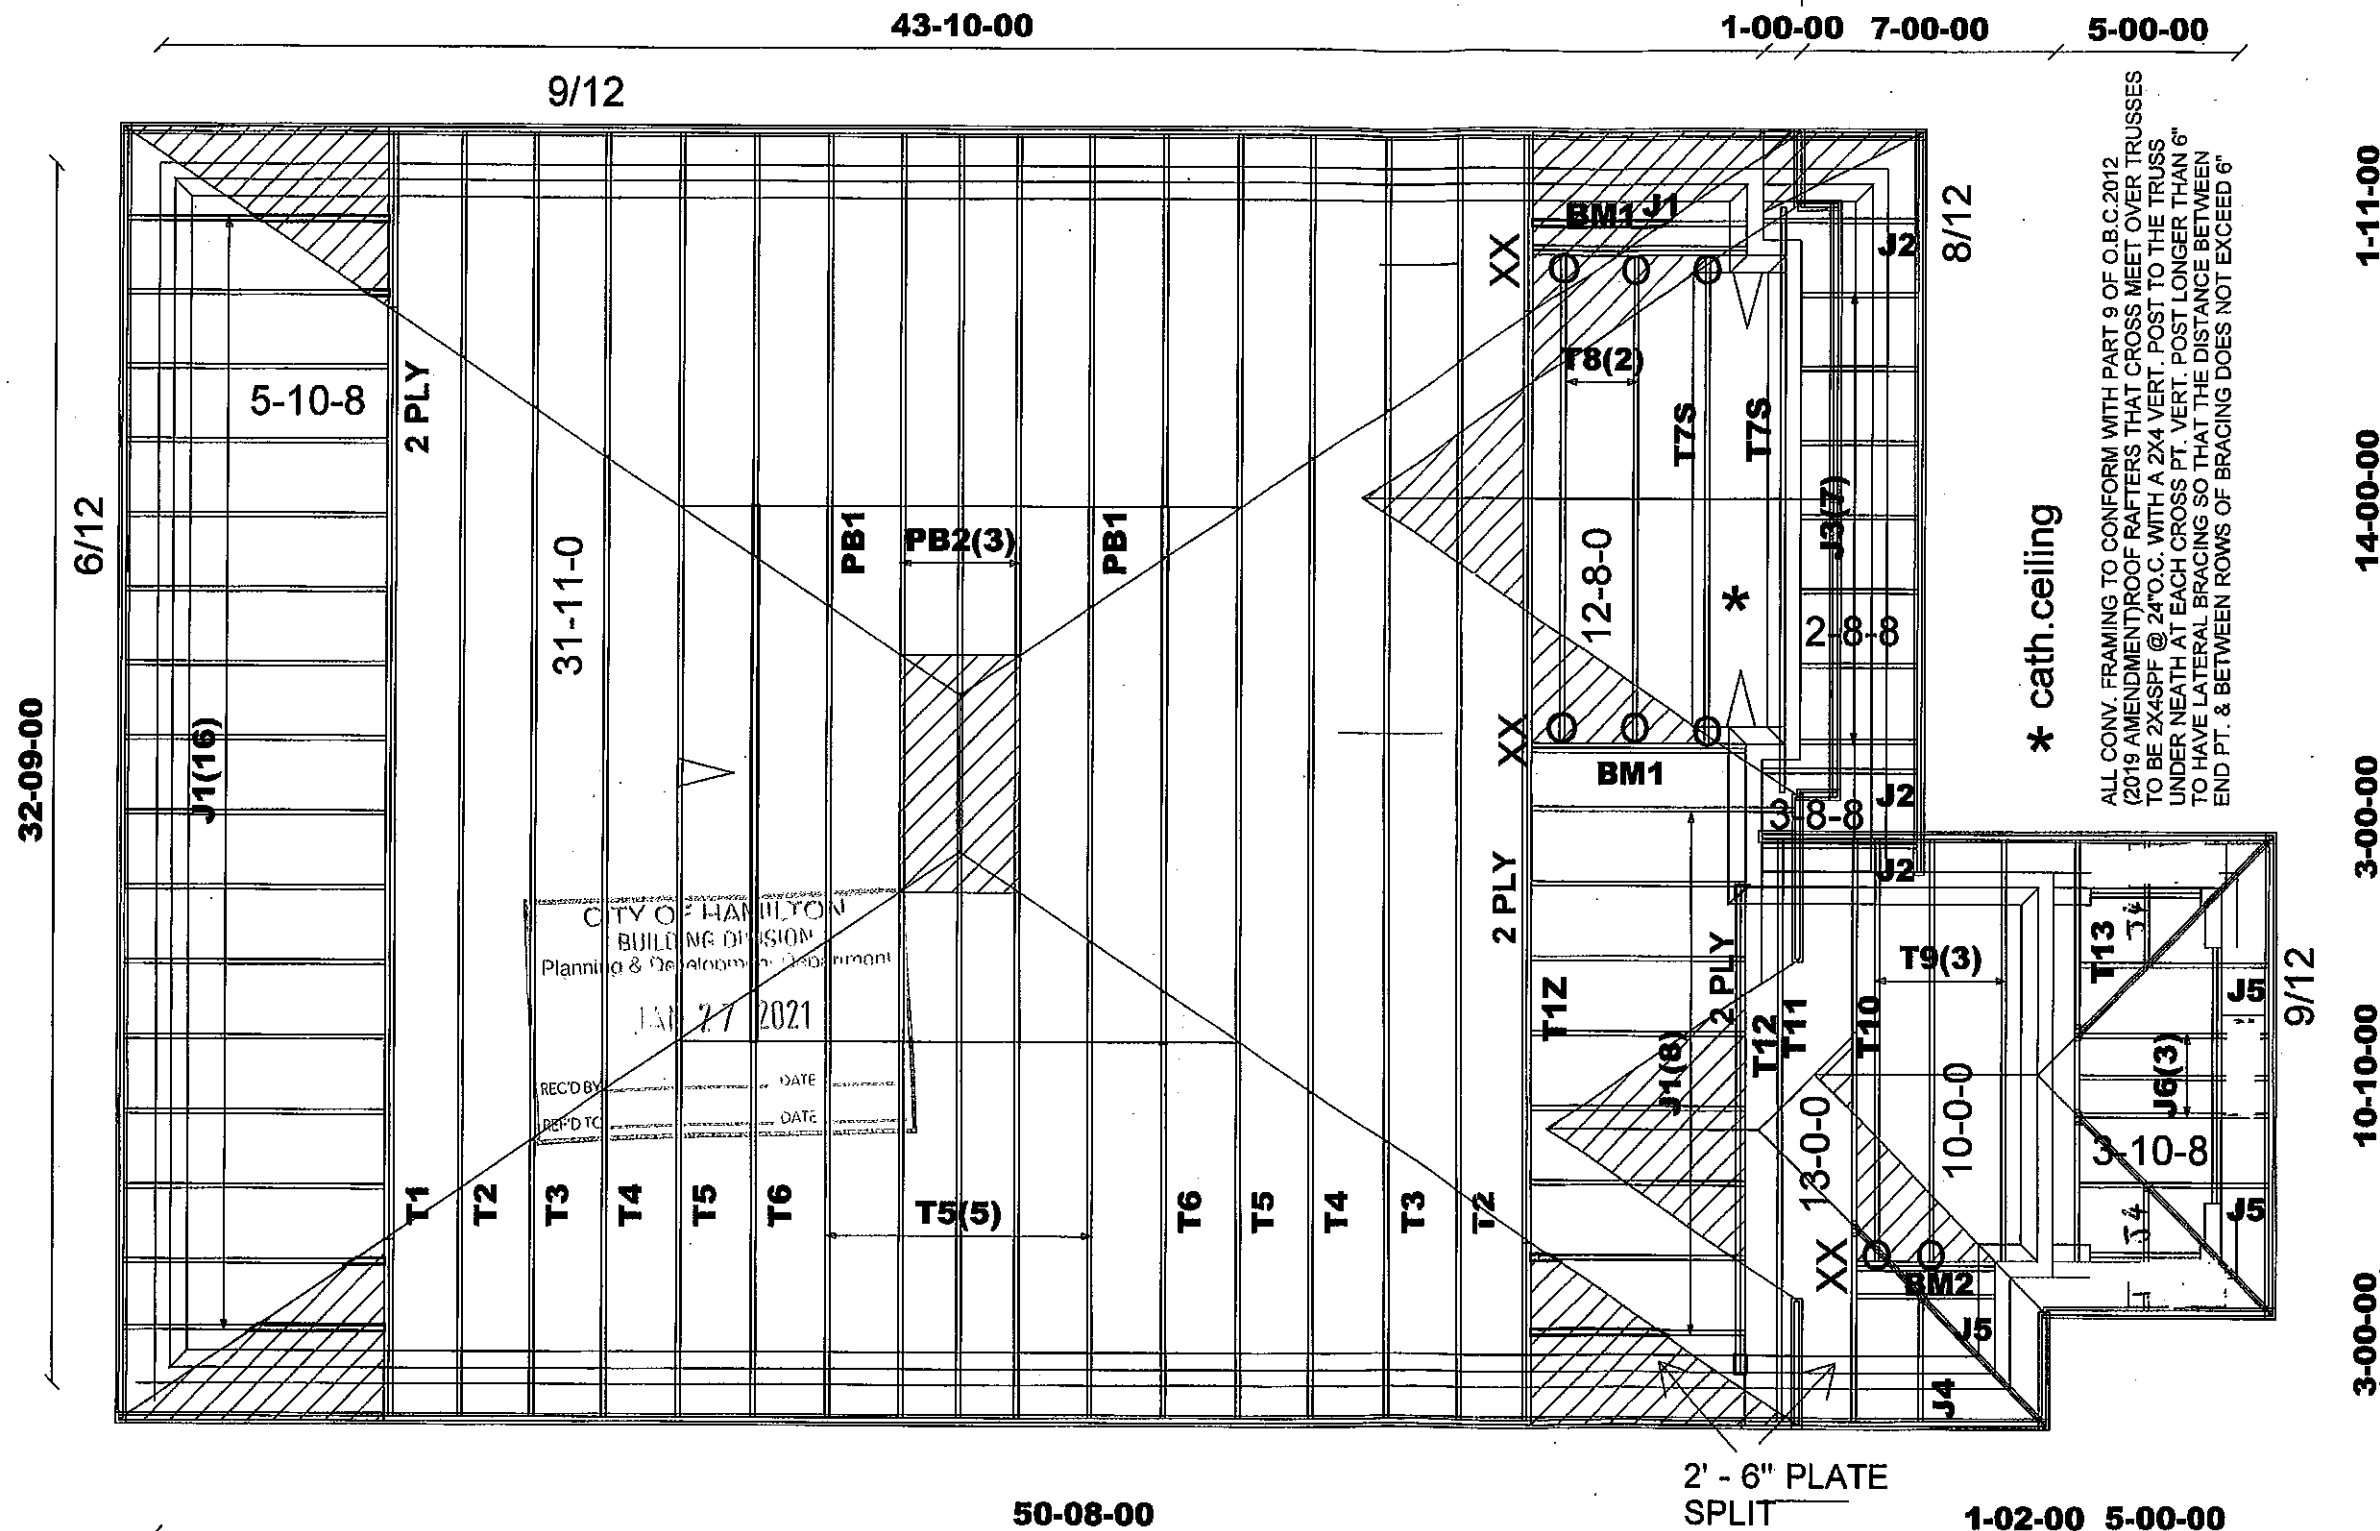

ASPHALT SHINGLES
12" FINISHED OH.
R.T.M.C.
2X6 EXTERIOR WALLS
2X6 FASCIA BOARD

HARDWARE:
LUS24 - (O)
HGUS26-2 - (XX)

DENOTES
CONV.
FRAMING



DESIGN CONFORMS
WITH O.B.C.2012 PART 9
(2019 AMENDMENT)
DESIGN LOADS:
SNOW LOAD 25.6 PSF
TC DEAD 6 PSF
BC LIVE 0 PSF
BC DEAD 7.4 PSF

BM1, BM2 = 2-2X10

M13109




Job Track: 51225
Plan Log: 202403
Layout ID: 408157

Builder / Location:
GREEN PARK HOMES / WATERDOWN
Project: **RUSSELL GARDENS PH.3**
Date: 2020-04-15 Sales: Mario DiCano Designer: AC/IG

Model / Elevation:
VALLEYCREEK 3/1 LOT 89

Milek ver 8.3.1.215

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

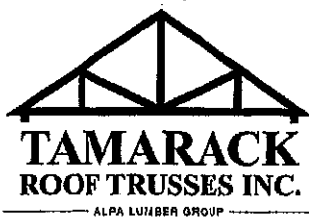

DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: VALLEYCREEK 3
 Lot #: 089
 Elevation: 1



Job Track: 51225
 PlanLog: 202403
 Layout ID: 408157
 Ref #
 Page: 1 of 2
 Date: 04-15-2020
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	9/12	31-11-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-06-04 1-06-04	289.32 181.33		
	1 2-ply	T1Z Hip Girder	9/12	31-11-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-06-04 1-06-04	289.32 181.33		
	2	T2 Hip	9/12	31-11-00	5-01-04	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	281.72 163.00		
	2	T3 Hip	9/12	31-11-00	6-01-04	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	270.76 172.33		
	2	T4 Hip	9/12	31-11-00	7-01-04	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	291.19 187.00		
	7	T5 Hip	9/12	31-11-00	8-01-04	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	1048.33 665.00		
	2	T6 Hip	9/12	31-11-00	9-01-04	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	312.24 194.33		
	2	T7S Scissor	9/12 6/12	13-02-00	6-03-04	2 x 4	1-03-08 1-03-08	6-04 6-04	104.77 70.00		
	2	T8 Common	9/12	12-08-00	6-05-08	2 x 4		1-08-08 1-08-08	110.88 72.67		
	3	T9 Common	9/12	9-11-08	5-03-04	2 x 4	1-03-12 1-03-12	1-06-04 1-06-04	131.2 88.50		
	1	T10 Hip Girder	9/12	13-00-00	4-05-02	2 x 4 2 x 6	1-03-08 1-03-08	1-06-04 1-06-04	65 42.83		
	1	T11 Hip	9/12	13-00-00	5-11-02	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	62.02 41.00		
	1 2-ply	T12 Flat	0/12	13-00-00	2-06-00	2 x 4		2-06-00 2-06-00	95.96 59.00		
	1	T13 Hip Girder	9/12	10-00-00	4-05-02	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	47.5 31.17		

 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: VALLEYCREEK 3 Lot #: 089 Elevation: 1	Job Track: 51225 PlanLog: 202403 Layout ID: 408157 Ref # Page: 2 of 2 Date: 04-15-2020 Designer: Andrew Conway Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	PB1 Piggyback	9 /12	14-04-05	2-00-00	2 x 4			86.07 57.33		
	3	PB2 Piggyback	9 /12	14-04-05	3-00-00	2 x 4			127.21 79.50		
	25	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	419.86 266.67		
	3	J2 Jack-Open	8 /12	3-08-08	3-08-03	2 x 4	1-03-08	4-07 2-03-13	35.4 24.00		
	7	J3 Jack-Open	8 /12	2-08-08	3-00-03	2 x 4	1-03-08	4-07 1-07-13	65.04 42.00		
	3	J4 Jack-Open	9 /12	1-10-15	2-11-07	2 x 4	1-03-08 1-01	1-06-04 2-11-07	29.84 22.50		
	3	J5 Jack-Open	9 /12	1-10-15	2-11-07	2 x 4	1-03-08 1-11-09	1-06-04 2-11-07	35.56 25.00		
	3	J6 Jack-Open	9 /12	3-10-08	4-05-02	2 x 4	1-03-08	1-06-04 4-05-02	45.15 30.50		

TOTAL # TRUSS= 80 TOTAL BFT OF ALL TRUSSES= 2694.99 BFT. TOTAL WEIGHT OF ALL TRSSES 4224.41 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
8	Hardware	LUS24	
3	Hardware	HGUS26-2	


TOTAL NUMBER OF
ITEMS= 11

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408157	T1	1	2	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Wed Apr 15 12:13:24 2020 Page 1

ID:7R4Dq_C9IAuONuKpiv7nzzwO4-ZAyihQa1x998vyscuuXFRGsa_lqREu8rA9muqdzQUhP



CHORDS	SIZE	LUMBER	DESCR.
A - O	2x4	DRY	No.2
C - F	2x4	DRY	2100F 1.8E
F - H	2x4	DRY	2100F 1.8E
H - J	2x4	DRY	No.2
S - B	2x6	DRY	No.2
K - I	2x6	DRY	No.2
S - P	2x6	DRY	No.2
P - N	2x6	DRY	No.2
N - K	2x6	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	1 12	SIDE(81.0)
C-F	1 12	SIDE(85.9)
F-H	1 12	SIDE(85.9)
H-J	1 12	SIDE(81.0)
S-B	2 12	TOP
K-I	2 12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S-P	2 12	SIDE(0.0)
P-N	2 12	SIDE(0.0)
N-K	2 12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	1 6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVV-p	MT20	5.0	6.0	1.25	3.00
C	TTWW-m	MT20	7.0	8.0	Edge	3.00
D	TMWW-t	MT20	4.0	4.0		
E	TMWW-w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMWW-l	MT20	4.0	4.0		
H	TTWW-m	MT20	7.0	8.0	Edge	3.00
I	TMVV-p	MT20	5.0	6.0	1.25	3.00
K	BMV-t-p	MT20	3.0	6.0		
L, M, Q, R						
L	BMWW-t	MT20	5.0	6.0		
N	BS-t	MT20	5.0	6.0		
O	BMWW-w-t	MT20	5.0	6.0		
P	BS-t	MT20	5.0	6.0		
S	BMV-t-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	DOWN	0	0
S	3148	0	3148	0
K	3047	0	3047	0

UNFACTORED REACTIONS	1ST LOASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
S	2224	1474 / 0
K	2155	1417 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.35 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)
FR-TO						FR-TO			
A-B	0 / 38	-91.8	-91.8	0.07 (1)	10.00	R-C	-619 / 0	0.08 (1)	
B-T	-3285 / 0	-91.8	-91.8	0.17 (1)	4.88	C-Q	0 / 3382	0.42 (1)	
T-C	-3285 / 0	-91.8	-91.8	0.17 (1)	4.88	Q-D	-1535 / 0	0.20 (1)	
C-U	-5545 / 0	-91.8	-91.8	0.40 (1)	4.83	D-O	0 / 883	0.12 (1)	
U-V	-5545 / 0	-91.8	-91.8	0.40 (1)	4.83	O-E	-841 / 0	0.11 (1)	
V-W	-5545 / 0	-91.8	-91.8	0.40 (1)	4.83	E-G	0 / 1023	0.13 (1)	
W-D	-5545 / 0	-91.8	-91.8	0.40 (1)	4.83	M-G	-1562 / 0	0.20 (1)	
D-X	-6388 / 0	-91.8	-91.8	0.43 (1)	4.35	M-H	0 / 3429	0.42 (1)	
X-Y	-6388 / 0	-91.8	-91.8	0.43 (1)	4.35	L-H	-590 / 0	0.07 (1)	
Y-Z	-6388 / 0	-91.8	-91.8	0.43 (1)	4.35	B-R	0 / 2774	0.34 (1)	
Z-E	-6388 / 0	-91.8	-91.8	0.43 (1)	4.35	L-I	0 / 2690	0.33 (1)	
E-AA	-6388 / 0	-91.8	-91.8	0.43 (1)	4.35				
AA-F	-6388 / 0	-91.8	-91.8	0.43 (1)	4.35				
F-AB	-6388 / 0	-91.8	-91.8	0.43 (1)	4.35				
AB-AC	-6388 / 0	-91.8	-91.8	0.43 (1)	4.35				
AC-G	-6388 / 0	-91.8	-91.8	0.43 (1)	4.35				
G-AD	-5508 / 0	-91.8	-91.8	0.40 (1)	4.84				
AD-AE	-5508 / 0	-91.8	-91.8	0.40 (1)	4.84				
AE-AF	-5508 / 0	-91.8	-91.8	0.40 (1)	4.84				
AF-H	-5508 / 0	-91.8	-91.8	0.40 (1)	4.84				
H-I	-3217 / 0	-91.8	-91.8	0.15 (1)	5.05				
I-J	0 / 38	-91.8	-91.8	0.07 (1)	10.00				
S-B	-3127 / 0	0.0	0.0	0.11 (1)	7.81				
K-I	-3028 / 0	0.0	0.0	0.11 (1)	7.81				

S-AG	0 / 0	-18.5	-18.5	0.08 (1)	10.00
AG-AH	0 / 0	-18.5	-18.5	0.08 (1)	10.00
AH-R	0 / 0	-18.5	-18.5	0.08 (1)	10.00
R-AI	0 / 2830	-18.5	-18.5	0.21 (1)	10.00
AI-AJ	0 / 2830	-18.5	-18.5	0.21 (1)	10.00
AJ-AK	0 / 2830	-18.5	-18.5	0.21 (1)	10.00
AK-Q	0 / 2690	-18.5	-18.5	0.21 (1)	10.00
Q-AL	0 / 6545	-18.5	-18.5	0.42 (1)	10.00
AL-P	0 / 5545	-18.5	-18.5	0.42 (1)	10.00
P-AM	0 / 5545	-18.5	-18.5	0.42 (1)	10.00
AM-AN	0 / 5545	-18.5	-18.5	0.42 (1)	10.00
AN-O	0 / 5545	-18.5	-18.5	0.42 (1)	10.00
O-AP	0 / 5506	-18.5	-18.5	0.42 (1)	10.00
AP-N	0 / 5506	-18.5	-18.5	0.42 (1)	10.00
N-AQ	0 / 5506	-18.5	-18.5	0.42 (1)	10.00
AQ-M	0 / 5506	-18.5	-18.5	0.42 (1)	10.00
M-AR	0 / 2550	-18.5	-18.5	0.21 (1)	10.00

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL = 25.0	PSF
	DL = 8.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. G/G

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD ORDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD)
EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")
CALCULATED VERT. DEFL.(LL) = L/999 (0.16")
ALLOWABLE DEFL.(TL) = L/360 (1.08")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSI: TC=0.43/1.00 (E-G:1), BC=0.42/1.00 (O-Q:1),
WB=0.42/1.00 (H-M:1), SS=0.23/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1887


PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.83 (O) (INPUT = 0.80)
JSI METAL= 0.54 (N) (INPUT = 1.00)

Structural component only 1/2
DWG# T-2006181

CONTINUED ON PAGE 2

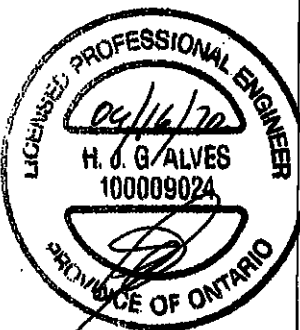

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408157	T1	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 6.310 S Oct 29 2019 MITek Industries, Inc. Wed Apr 15 12:13:24 2020 Page 2
ID:7R4Dg C9IAuIONuKplw?nzzlWO4-ZAvihQa1x998vysuuXFRGsa IaREu6rA9murdzQUhP

LOADING

TOTAL LOAD CASES: (4)


CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. FACTORED UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO			FR-TO		
AR-AS	0/2850	-18.5	-18.5 0.21 (1)	10.00			
AS-AT	0/2850	-18.5	-18.5 0.21 (1)	10.00			
AT-L	0/2850	-18.5	-18.5 0.21 (1)	10.00			
L-AU	0/0	-18.5	-18.5 0.08 (4)	10.00			
AU-AV	0/0	-18.5	-18.5 0.08 (4)	10.00			
AV-K	0/0	-18.5	-18.5 0.08 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	3-5-5	-44	-49	---	FRONT	VERT	DEAD	---	C1
C	3-5-5	-225	-225	---	FRONT	VERT	SNOW	---	C1
H	28-5-11	-44	-49	---	FRONT	VERT	DEAD	---	C1
H	28-5-11	-225	-225	---	FRONT	VERT	SNOW	---	C1
T	3-0-12	-139	-139	---	FRONT	VERT	TOTAL	---	C1
U	5-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	7-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	9-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	11-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	13-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	15-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	17-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	19-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	21-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	23-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	25-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	27-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AG	1-0-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AH	3-0-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AI	5-0-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AJ	7-0-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AK	9-0-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AL	11-0-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AM	13-0-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AN	15-0-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AO	17-0-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AP	19-0-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AQ	21-0-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AR	23-0-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AS	25-0-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AT	27-0-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AU	29-0-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AV	30-10-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

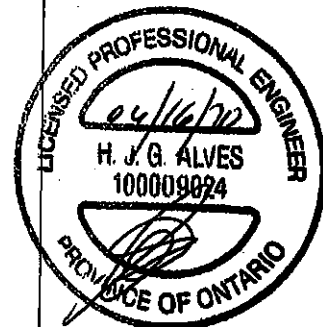

Structural component only
DWG# T-2006181



7/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408157	T1Z	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 12:13:25 2020 Page 1

ID:7R4Dq_C9IAuIONuKpIv7nzzlwO4-1NW1umbIT7HX6RoSc2U_TPKY97UzK3_PpWSDS3zQUHc

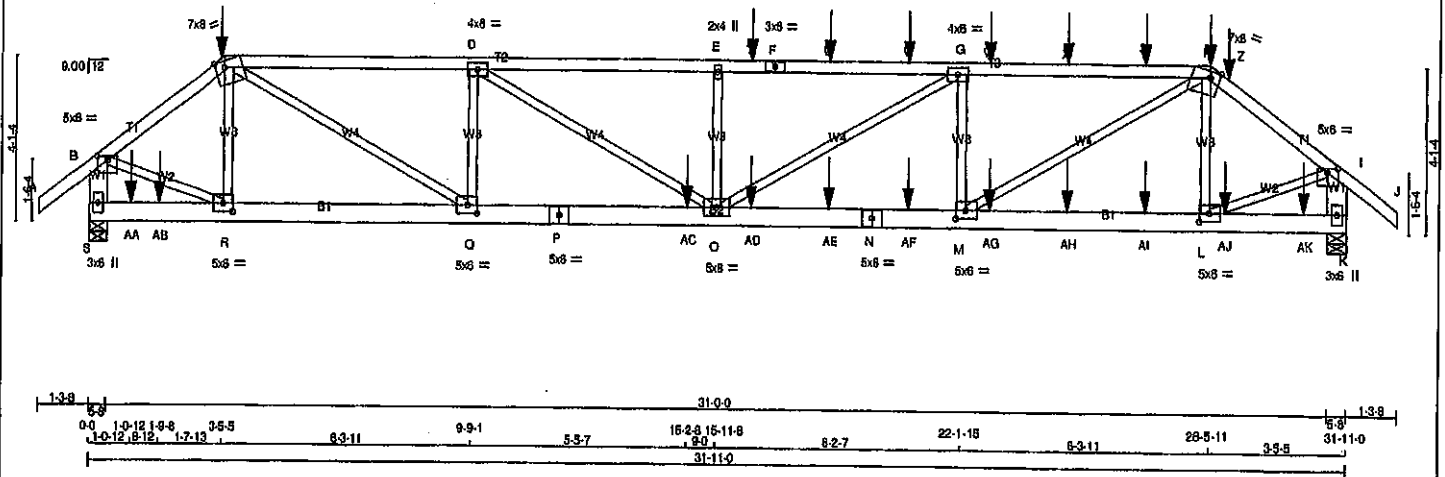

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - F	2x4	DRY 2100F 1.8E	SPF
F - H	2x4	DRY 2100F 1.8E	SPF
H - J	2x4	DRY No.2	SPF
J - K	2x4	DRY No.2	SPF
K - L	2x4	DRY No.2	SPF
L - M	2x4	DRY No.2	SPF
M - N	2x4	DRY No.2	SPF
N - K	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-O	12	SIDE (61.0)
C-F	12	SIDE (65.0)
F-H	12	SIDE (65.0)
H-J	12	SIDE (61.0)
J-K	12	TOP
K-L	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
S-P	12	SIDE (0.0)
P-N	12	SIDE (0.0)
N-K	12	SIDE (0.0)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	1.25	3.00
C TTWW-m	MT20	7.0	8.0	Edge	3.00
D TMVW-i	MT20	4.0	8.0		
E TMVW-w	MT20	2.0	4.0		
F TS-i	MT20	3.0	8.0		
G TMVW-i	MT20	4.0	8.0		
H TTWW-m	MT20	7.0	8.0	Edge	3.00
I TMVW-p	MT20	5.0	8.0	1.25	3.00
K BMV1-p	MT20	3.0	8.0		
L, M, Q, R					
N BMVW-i	MT20	5.0	8.0	2.50	2.75
O BS-i	MT20	5.0	8.0		
P BMVW-i	MT20	5.0	8.0		
Q BS-i	MT20	5.0	8.0		
S BMV1-p	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	REQD BRG IN-SX
JT	VERT	HORZ	DOWN	HORZ
S	4216	0	4216	0
K	3532	0	3532	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	3082	1457 / 0	0 / 0	0 / 0	0 / 0	1624 / 0	0 / 0	0 / 0
K	2532	1488 / 0	0 / 0	0 / 0	0 / 0	1084 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING - 3.89 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)
FR-TO				MEMB.		
A-B	0 / 38	-91.8	-91.8 0.07 (1)	R-C	-144 / 216	0.04 (4)
B-C	-3988 / 0	-91.8	-91.8 0.17 (1)	C-Q	0 / 3856	0.45 (1)
C-D	-8312 / 0	-91.8	-91.8 0.28 (1)	Q-D	-1680 / 0	0.21 (1)
D-E	-8075 / 0	-91.8	-91.8 0.34 (1)	D-O	0 / 2057	0.25 (1)
E-F	-8075 / 0	-91.8	-91.8 0.50 (1)	O-E	-880 / 0	0.09 (1)
F-G	-8075 / 0	-91.8	-91.8 0.59 (1)	G-O	0 / 1905	0.25 (4)
G-H	-8075 / 0	-91.8	-91.8 0.69 (1)	H-M	-1981 / 0	0.25 (1)
H-I	-8075 / 0	-91.8	-91.8 0.80 (1)	M-H	0 / 4098	0.51 (1)
I-J	-8075 / 0	-91.8	-91.8 0.85 (1)	L-H	-704 / 0	0.09 (1)
J-K	-8075 / 0	-91.8	-91.8 0.85 (1)	H-R	0 / 3316	0.41 (1)
K-L	-8075 / 0	-91.8	-91.8 0.85 (1)	L-I	0 / 3159	0.39 (1)
W-X	-8528 / 0	-91.8	-91.8 0.45 (1)			
X-Y	-8528 / 0	-91.8	-91.8 0.45 (1)			
Y-H	-8528 / 0	-91.8	-91.8 0.45 (1)			
H-Z	-3748 / 0	-91.8	-91.8 0.18 (1)			
Z-I	-3748 / 0	-91.8	-91.8 0.18 (1)			
I-J	0 / 38	-91.8	-91.8 0.07 (1)			
S-B	-3685 / 0	0.0	0.0 0.13 (1)			
K-I	-3520 / 0	0.0	0.0 0.13 (1)			
S-AA	0 / 0	-18.5	-18.5 0.45 (4)			
AA-AB	0 / 0	-18.5	-18.5 0.45 (4)			
AB-R	0 / 0	-18.5	-18.5 0.45 (4)			
R-Q	0 / 3161	-18.5	-18.5 0.33 (1)			
Q-P	0 / 8312	-18.5	-18.5 0.63 (1)			
P-A	0 / 6312	-18.5	-18.5 0.63 (1)			
AC-O	0 / 6312	-18.5	-18.5 0.63 (1)			
Q-AD	0 / 8528	-18.5	-18.5 0.52 (1)			
AD-AE	0 / 8528	-18.5	-18.5 0.52 (1)			
AE-N	0 / 8528	-18.5	-18.5 0.52 (1)			
N-AF	0 / 8528	-18.5	-18.5 0.52 (1)			
AF-M	0 / 8528	-18.5	-18.5 0.52 (1)			
M-AQ	0 / 2996	-18.5	-18.5 0.25 (1)			
AG-AH	0 / 2996	-18.5	-18.5 0.25 (1)			
AH-AI	0 / 2996	-18.5	-18.5 0.25 (1)			
AI-L	0 / 2996	-18.5	-18.5 0.25 (1)			
L-AJ	0 / 0	-18.5	-18.5 0.08 (4)			
AJ-AK	0 / 0	-18.5	-18.5 0.08 (4)			
AK-K	0 / 0	-18.5	-18.5 0.08 (4)			

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	3-5-5	-44	-49	---	---	FRONT	VERT	DEAD	---	C1
C	3-5-5	-225	-225	---	---	FRONT	VERT	SNOW	---	C1

TOTAL WEIGHT = 2 X 145 = 290 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 33.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***
ADDTL. USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.08")
CALCULATED VERT. DEFL. (LL) = L/999 (0.15")
ALLOWABLE DEFL. (TL) = L/360 (1.08")
CALCULATED VERT. DEFL. (TL) = L/999 (0.38")

CSI: TC=0.50/1.00 (E-G:1), BC=0.63/1.00 (O-Q:1),
WB=0.51/1.00 (H-M:1), SS=0.50/1.00 (O-Q:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 765 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (Q) (INPUT = 0.90)
JSI METAL = 0.87 (N) (INPUT = 1.00)

Structural component only
DWG# T-2006182

CONTINUED ON PAGE 2

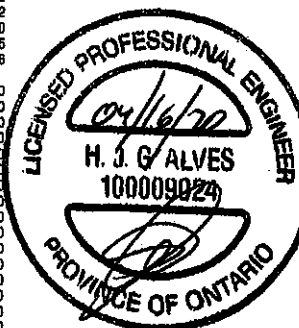


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408157	T1Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 8 Oct 29 2019 Mittek Industries, Inc. Wed Apr 15 12:13:25 2020 Page 2
ID:7R4Dg C9/AuIONuKpLv7nzzlwQ4-1NW1umbIITH7X8RoSc2U TPKY87Uzk3 PoWSD3zQUhC

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
H	28-5-11	-44	-49	---	FRONT	VERT	DEAD	---	C1
H	28-5-11	-225	-225	---	FRONT	VERT	SNOW	---	C1
T	18-10-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	18-10-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	20-10-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	22-10-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
X	24-10-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
Y	28-10-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
Z	28-10-4	-139	-139	---	BACK	VERT	TOTAL	---	C1
AA	1-0-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
AB	1-9-8	-1200	-1200	---	BACK	VERT	TOTAL	---	C1
AC	15-2-8	-1200	-1200	---	BACK	VERT	TOTAL	---	C1
AD	16-10-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AE	18-10-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AF	20-10-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AG	22-10-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AH	24-10-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AI	28-10-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AJ	28-10-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AK	30-10-4	-28	-28	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

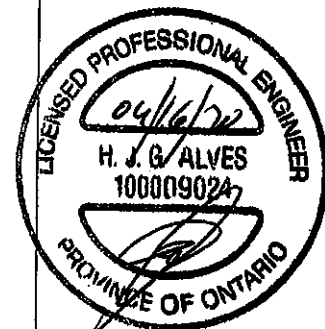


Structural component only
DWG# T-2006182

42

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408158	T1Z1	1	2	GREEN PARK HOMES		

Tamareck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Mon Apr 20 14:09:16 2020 Page 1
 ID:7R4Dg_C9iAulONuKpiv7nzzwO4-CK8d4LnC7AUzQTmgEld8iMwKlUzXXRBYk1QcJ7izOpWrr
 20-10-4 22-1-15 28-5-11 28-10-4 31-11-0 33-2-8
 1-3-8 3-0-12 3-0-12 3-5-5 5-3-11 9-9-1 5-2-7 15-11-8 4-10-12 1-3-11 5-3-11 28-5-11 28-10-4 31-11-0 33-2-8
 Scale = 1:52.6

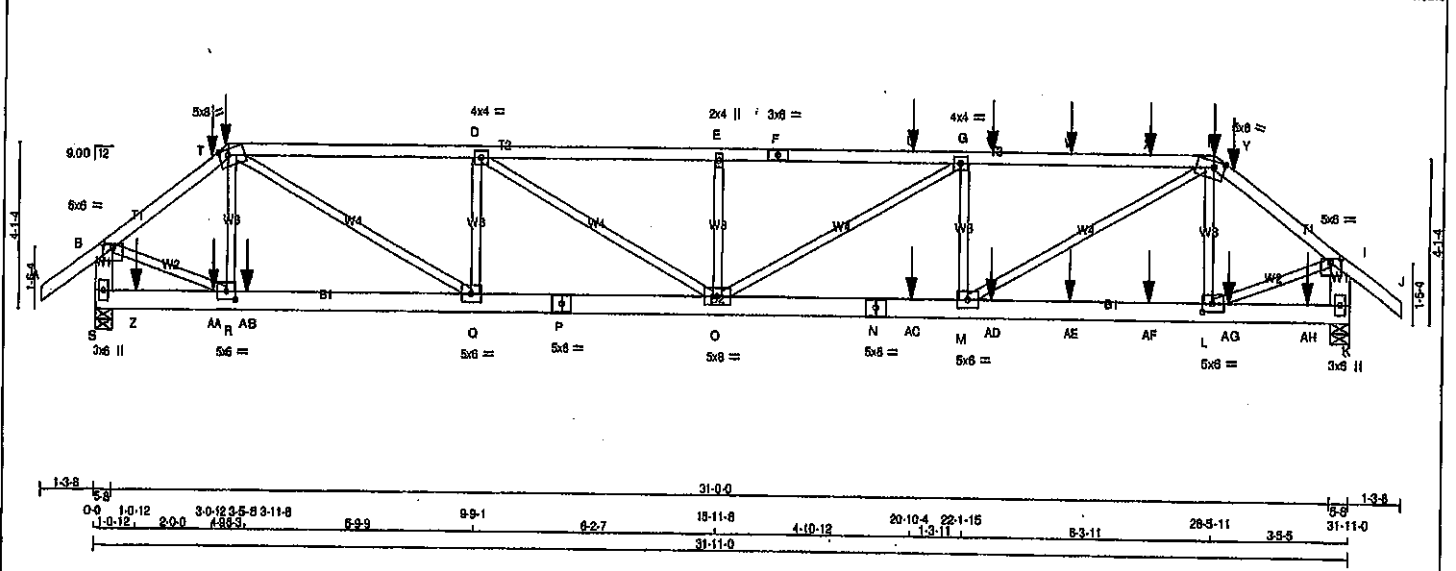

LUMBER
 N. L. G. A. RULES
 CHORDS SIZE LUMBER DESOR.
 A - C 2x4 DRY 1650F 1.5E SPF
 C - F 2x4 DRY 1650F 1.5E SPF
 F - H 2x4 DRY 1650F 1.5E SPF
 H - J 2x4 DRY 1650F 1.5E SPF
 S - B 2x8 DRY No.2 SPF
 K - I 2x8 DRY No.2 SPF
 S - P 2x8 DRY No.2 SPF
 P - N 2x8 DRY No.2 SPF
 N - K 2x8 DRY No.2 SPF
 ALL WEBS 2x3 DRY No.2 SPF
 EXCEPT

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	JT	DOWN	JT	IN-SX	JT	IN-SX
S	3810	0	3810	0	5-8	5-8	5-8
K	2915	0	2915	0	5-8	5-8	5-8

UNFACTORED REACTIONS		MAX/MIN. COMPONENT REACTIONS	
JT	COMBINED	JT	SNOW
S	2545	1716 / 0	0 / 0
K	2057	1375 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K
BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD	MAX. (LBS)	MEMB.	FORCE (LBS)

FR-TO	MAX. FACTORED	FACTORED	VERT. LOAD	MAX. (LBS)	UNBRAC	MEMB.	FORCE	MAX.
A-B	0 / 38	-91.8	-91.8	0.08 (1)	10.00	R-C	0 / 487	0.08 (1)

B-T	-3885 / 0	-91.8	-91.8	0.13 (1)	5.27	C-Q	0 / 2165	0.27 (1)
T-C	-3885 / 0	-91.8	-91.8	0.13 (1)	5.27	Q-D	-921 / 0	0.12 (1)

C-D	-5008 / 0	-91.8	-91.8	0.35 (1)	4.43	D-O	0 / 541	0.07 (1)
D-E	-5489 / 0	-91.8	-91.8	0.35 (1)	4.43	O-E	-512 / 0	0.08 (1)

E-F	-5489 / 0	-91.8	-91.8	0.49 (1)	4.25	C-Q	0 / 837	0.08 (1)
F-U	-5489 / 0	-91.8	-91.8	0.49 (1)	4.25	M-G	-1308 / 0	0.17 (1)

U-G	-5489 / 0	-91.8	-91.8	0.49 (1)	4.25	M-H	0 / 2912	0.36 (1)
G-V	-4922 / 0	-91.8	-91.8	0.47 (1)	4.44	L-H	-590 / 0	0.07 (1)

V-W	-4922 / 0	-91.8	-91.8	0.47 (1)	4.44	B-R	0 / 3278	0.41 (1)
W-X	-4922 / 0	-91.8	-91.8	0.47 (1)	4.44	L-I	0 / 2544	0.31 (1)

X-H	-4922 / 0	-91.8	-91.8	0.12 (1)	5.81			
H-Y	-3010 / 0	-91.8	-91.8	0.12 (1)	5.81			

Y-I	-3010 / 0	-91.8	-91.8	0.12 (1)	5.81			
I-J	0 / 38	-91.8	-91.8	0.08 (1)	10.00			


S-B	-3839 / 0	0.0	0.0	0.13 (1)	7.37			
K-I	-2893 / 0	0.0	0.0	0.10 (1)	7.81			

S-Z	0 / 0	-18.5	-18.5	0.11 (1)	10.00			
Z-AA	0 / 0	-18.5	-18.5	0.11 (1)	10.00			

AA-R	0 / 0	-18.5	-18.5	0.11 (1)	10.00			
R-AB	0 / 3139	-18.5	-18.5	0.31 (1)	10.00			

AB-Q	0 / 3139	-18.5	-18.5	0.31 (1)	10.00			
Q-P	0 / 5005	-18.5	-18.5	0.38 (1)	10.00			

P-O	0 / 5005	-18.5	-18.5	0.38 (1)	10.00			
O-N	0 / 4922	-18.5	-18.5	0.37 (1)	10.00			

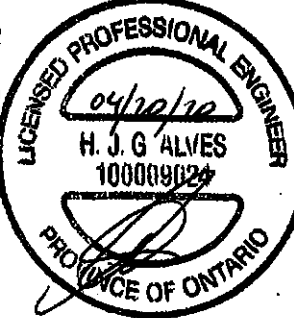

DESIGN CRITERIA
 *** SPECIAL LOADS ANALYSIS ***
 GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
 LOADS WERE DERIVED FROM USER INPUT
 NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***
 ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06")
 CALCULATED VERT. DEFL.(LL) = L/899 (0.15")
 ALLOWABLE DEFL.(TL) = L/360 (1.06")
 CALCULATED VERT. DEFL.(TL) = L/998 (0.27")

CSI: TC=0.49/1.00 (E-O:1), SC=0.37/1.00 (M-O:1),
 WB=0.41/1.00 (B-R:1), SSI=0.43/1.00 (Q-R:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1887 1856

PLATE ROTATION TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.80 (1) (INPUT = 0.90)
 JSI METAL= 0.48 (1) (INPUT = 1.00)

Structural component only
 DWG# T-2006618

CONTINUED ON PAGE 2

JOB NAME 408158	TRUSS NAME T1Z1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 6.310 S Oct 29 2019 Mitek Industries, Inc. Mon Apr 20 14:09:18 2020 Page 2
ID:7R4Dg_C9IAuIONuKplv7nzzlwO4-CK8d4LnC7AUzQTmgEld6itMwKUzXXR8Yk1QcJ7izOpWt

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
U	20-10-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	22-10-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	24-10-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
X	26-10-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
Y	28-10-4	-139	-139	---	BACK	VERT	TOTAL	---	C1
Z	1-0-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AA	3-0-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AB	3-11-8	-1265	-1265	---	BACK	VERT	TOTAL	---	C1
AC	20-10-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AD	22-10-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AE	24-10-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AF	26-10-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AG	28-10-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AH	30-10-4	-26	-26	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2006618

JOB NAME 408157	TRUSS NAME T2	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	ORWG NO.
Temarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Wed Apr 15 12:13:26 2020 Page 1
 ID:7R4Dg_C9IAuIONuKpLv7nzzlwO4-WZ4P68cHTnPs8G0_0JZjWhxtGZV4lpn7eTF?IWzQUHN
 1-3-8 0-0 4-9-5 4-9-5 5-7-11 10-5-1 5-9-7 15-11-8 5-9-7 21-5-15 5-7-11 27-1-11 4-9-5 31-11-0 33-2-9 13-8
 Scale = 1:52.8

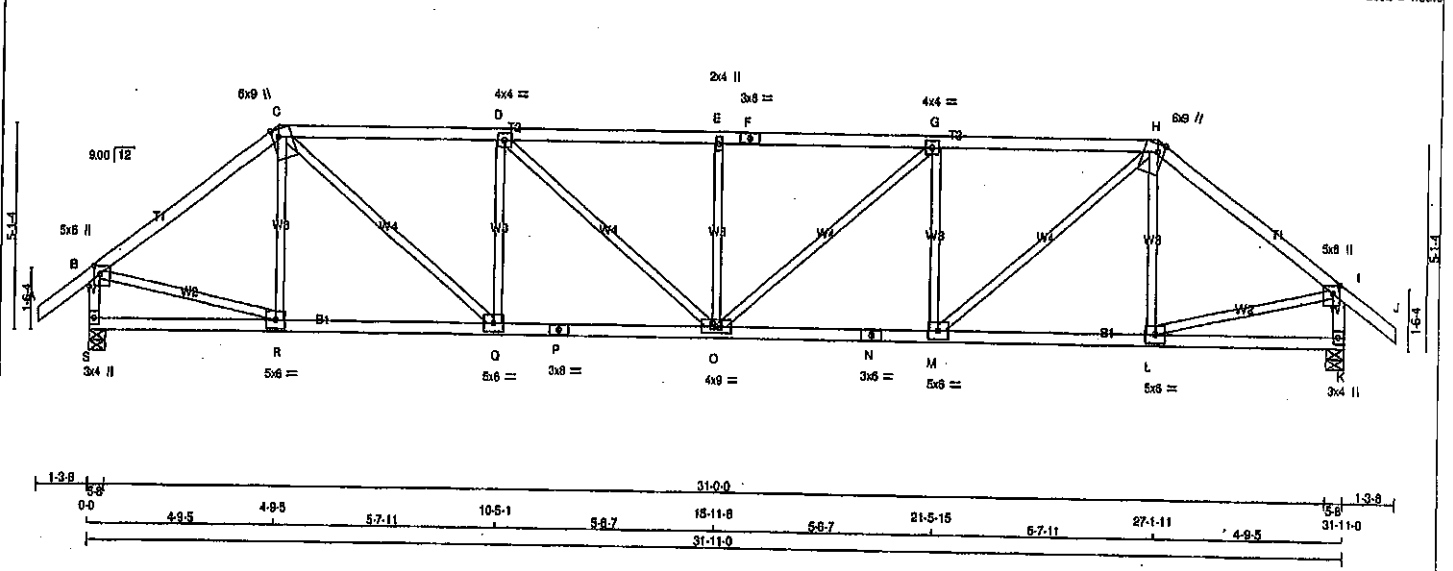

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
S - P	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMVW+p	MT20	5.0	6.0	2.50 2.00
C TTWW+m	MT20	8.0	9.0	Edge 2.00
D TMWW-i	MT20	4.0	4.0	
E TMWW+w	MT20	2.0	4.0	
F TS-i	MT20	3.0	6.0	
G TMWW-i	MT20	4.0	4.0	
H TTWW+m	MT20	6.0	9.0	Edge 2.00
I TMVW+p	MT20	5.0	6.0	2.50 2.00
K BMV1+p	MT20	3.0	4.0	
L, M, O, R				
L BMWW-i	MT20	5.0	6.0	
N BS-i	MT20	3.0	6.0	
O BMWW-i	MT20	4.0	9.0	
P BS-i	MT20	3.0	6.0	
S BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		RECORD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
S	1888	0	1888	0	0	5-8	5-8	5-8	5-8
K	1888	0	1888	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX/MIN COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
S	1331	887/0	0/0	0/0	0/0
K	1331	887/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.48 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO		FROM TO	CS (LC)	FR-TO		FROM TO	CS (LC)
A-B	0/38	-91.8	-91.8 0.12 (1)	10.00	R-C	-259/0	0.10 (1)
B-C	-1888/0	-91.8	-91.8 0.47 (1)	4.39	C-Q	0/1485	0.33 (1)
C-D	-2834/0	-91.8	-91.8 0.50 (1)	3.68	Q-D	-861/0	0.33 (1)
D-E	-2882/0	-91.8	-91.8 0.63 (1)	3.48	D-O	0/434	0.10 (1)
E-F	-2882/0	-91.8	-91.8 0.63 (1)	3.48	O-E	-488/0	0.18 (1)
F-G	-2882/0	-91.8	-91.8 0.83 (1)	3.48	O-G	0/434	0.10 (1)
G-H	-2834/0	-91.8	-91.8 0.80 (1)	3.68	M-G	-861/0	0.33 (1)
H-I	-1888/0	-91.8	-91.8 0.47 (1)	4.39	M-H	0/1485	0.33 (1)
I-J	0/38	-91.8	-91.8 0.12 (1)	10.00	L-H	-259/0	0.10 (1)
S-B	-1851/0	0.0	0.0 0.19 (1)	6.16	B-R	0/1552	0.35 (1)
K-I	-1851/0	0.0	0.0 0.19 (1)	6.16	L-I	0/1552	0.35 (1)
S-R	0/0	-18.5	-18.5 0.12 (4)	10.00			
R-Q	0/1502	-18.5	-18.5 0.31 (1)	10.00			
Q-P	0/2834	-18.5	-18.5 0.47 (1)	10.00			
P-O	0/2834	-18.5	-18.5 0.47 (1)	10.00			
O-N	0/2834	-18.5	-18.5 0.47 (1)	10.00			
N-M	0/2834	-18.5	-18.5 0.47 (1)	10.00			
M-L	0/1502	-18.5	-18.5 0.31 (1)	10.00			
L-K	0/0	-18.5	-18.5 0.12 (4)	10.00			

TOTAL WEIGHT = 2 X 131 = 262 lb

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 LL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBCC 2010, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.08")
 CALCULATED VERT. DEFL. (LL) = U/899 (0.15")
 ALLOWABLE DEFL. (TL) = L/360 (1.08")
 CALCULATED VERT. DEFL. (TL) = U/899 (0.27")

CS: TC=0.63/1.00 (D-E:1), BC=0.47/1.00 (M-O:1), WB=0.35/1.00 (L-I:1), SS=0.24/1.00 (G-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 818 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

SI GRIP= 0.90 (I) (INPUT = 0.80)
 SI METAL= 0.80 (P) (INPUT = 1.00)

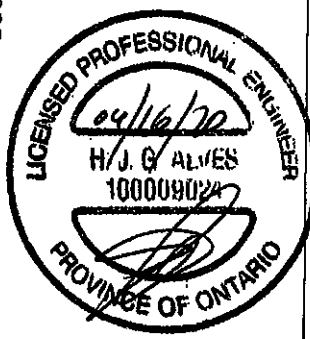

Structural component only
 DWG# T-2006183


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408157	T3	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 28 2019 MITek Industries, Inc. Wed Apr 16 12:13:27 2020 Page 1

ID:7R4Dg_C9IAuONuKpiv?nzzwO4-_tenJRCvD4YjmQaBa04y3uU7tyaR9EHs7?YHzC0Uhm

Scale = 1:52.8

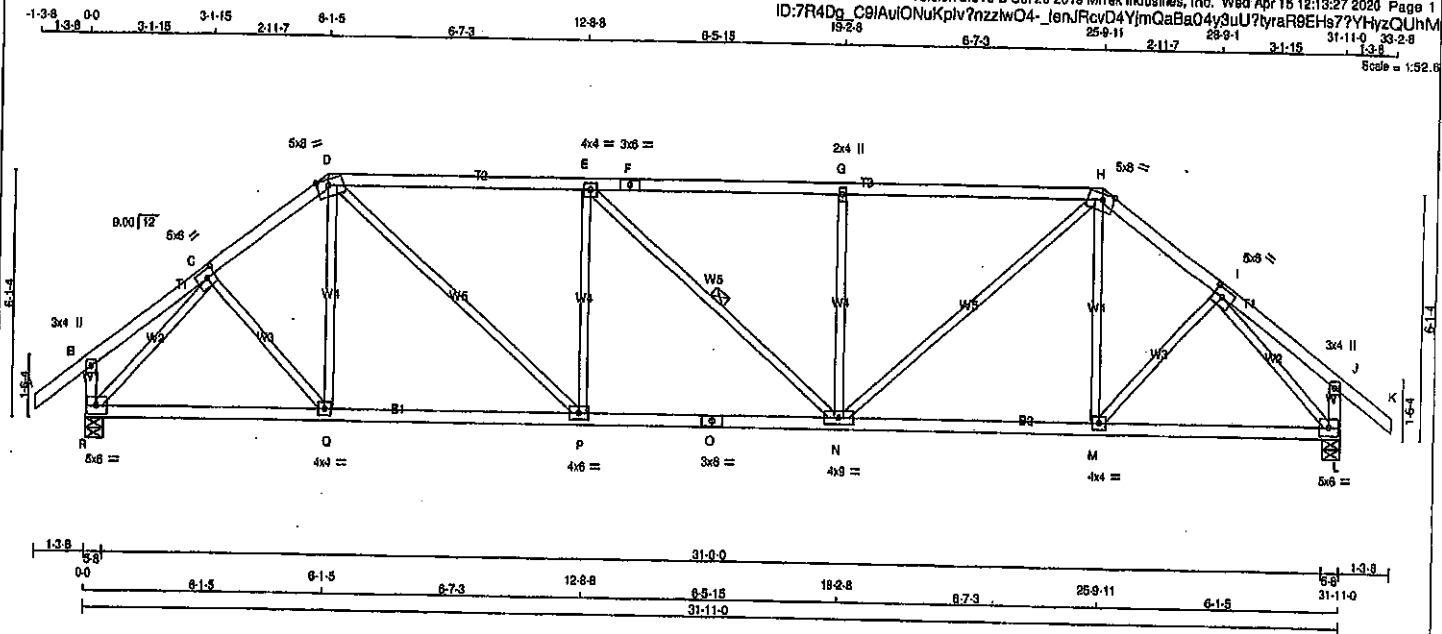

LUMBER			
N.L.G.A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
R - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
O - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMV-p	MT20	3.0	4.0
C	TMW-w	MT20	5.0	8.0
D	TTWW-m	MT20	5.0	8.0
E	TMW-w	MT20	4.0	4.0
F	TS-1	MT20	3.0	6.0
G	TMW-w	MT20	2.0	4.0
H	TTWW-m	MT20	5.0	8.0
I	TMW-w	MT20	5.0	8.0
J	TMV-p	MT20	3.0	4.0
L	BMVW-1	MT20	5.0	8.0
M	BMW-1	MT20	4.0	4.0
N	BMW-1	MT20	4.0	9.0
O	BS-1	MT20	3.0	8.0
P	BMW-1	MT20	4.0	8.0
Q	BMW-1	MT20	4.0	4.0
R	BMVW-1	MT20	5.0	8.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
R	1888	0	1888	0	0	5-8	5-8
L	1888	0	1888	0	0	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS		LIVE		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW
R	1331	887/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0
L	1331	887/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.63 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO			
A-B	0/38	-91.8	-91.8	0.12 (1)	10.00	C-Q	0/187
B-C	0/18	-91.8	-91.8	0.11 (1)	10.00	Q-D	0/77
C-D	-1914/0	-91.8	-91.8	0.18 (1)	4.73	D-P	0/1168
D-E	-2389/0	-91.8	-91.8	0.77 (1)	3.83	P-E	-852/0
E-F	-2389/0	-91.8	-91.8	0.78 (1)	3.83	E-N	-2/0
F-G	-2389/0	-91.8	-91.8	0.78 (1)	3.83	N-G	-651/0
G-H	-2389/0	-91.8	-91.8	0.78 (1)	3.83	H-N	0/1164
H-I	-1914/0	-91.8	-91.8	0.18 (1)	4.73	M-H	0/78
I-J	0/18	-91.8	-91.8	0.11 (1)	10.00	M-I	0/187
J-K	0/38	-91.8	-91.8	0.12 (1)	10.00	R-C	-2127/0
R-B	-239/0	0.0	0.0	0.02 (1)	7.81	I-L	-2128/0
L-J	-239/0	0.0	0.0	0.02 (1)	7.81		
R-Q	0/1401	-18.5	-18.5	0.32 (1)	10.00		
Q-P	0/1814	-18.5	-18.5	0.34 (1)	10.00		
P-O	0/2391	-18.5	-18.5	0.48 (1)	10.00		
O-N	0/2391	-18.5	-18.5	0.48 (1)	10.00		
N-M	0/1814	-18.5	-18.5	0.34 (1)	10.00		
M-L	0/1401	-18.5	-18.5	0.33 (1)	10.00		

TOTAL WEIGHT = 2 X 135 = 271 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 26.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.06")
CALCULATED VERT. DEFL. (LL) = L/989 (0.11")
ALLOWABLE DEFL. (TL) = L/360 (1.06")
CALCULATED VERT. DEFL. (TL) = L/989 (0.22")

CSI: TO=0.77/1.00 (D-E:1), SO=0.48/1.00 (N-P:1), WB=0.72/1.00 (I-L:1), SSI=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.88 (I) (INPUT = 0.50)
JSI METAL = 0.78 (O) (INPUT = 1.00)

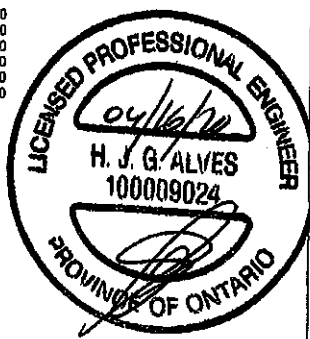

Structural component only
DWG# T-2006184

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408157	T4	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Wed Apr 16 12:13:28 2020 Page 1
 ID:7R4Dg_C9iAuONuKpiv7nzzlwO4-SyBAWndX_OgaOZ9N7kb6b61EcMBxAcGQ5mk6pOzQuhL
 1-3-8 0.0 3-9-15 3-9-15 3-7-7 7-5-5 5-8-8 13-1-14 5-7-4 18-9-2 5-8-8 24-5-11 3-7-7 28-1-1 3-9-15 31-11-0 33-2-8
 Scale = 1:82.0

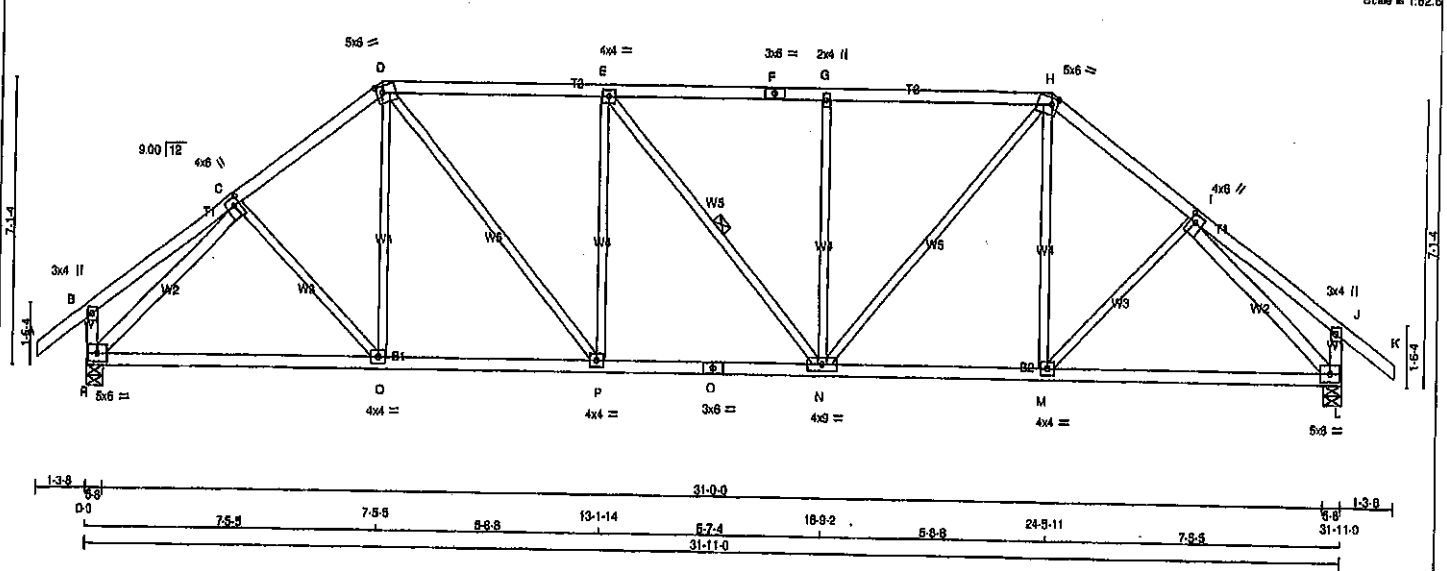

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - K	2x4	DRY	No.2	SPF	
K - L	2x4	DRY	No.2	SPF	
L - M	2x4	DRY	No.2	SPF	
M - N	2x4	DRY	No.2	SPF	
N - O	2x4	DRY	No.2	SPF	
O - P	2x4	DRY	No.2	SPF	
P - Q	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
R - C	2x4	DRY	No.2	SPF	
I - L	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW+t	MT20	4.0	8.0	2.25	1.75
D	TTWW-m	MT20	5.0	8.0	2.00	1.75
E	TMVW-t	MT20	4.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMVW-w	MT20	2.0	4.0		
H	TTWW-m	MT20	5.0	8.0	2.00	1.75
I	TMVW-t	MT20	4.0	6.0	2.25	1.75
J	TMV+p	MT20	3.0	4.0		
L	BMVW-t	MT20	5.0	8.0		
M, P, Q						
N	BMVW-t	MT20	4.0	4.0		
O	BS-t	MT20	4.0	9.0		
R	BMVW-t	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQD
JT	VERT	GROSS REACTION	DOWN	HORIZ	UPLIFT	BRG IN-SX	BRG IN-SX
R	1888	0	1888	0	0	5-8	5-8
L	1888	0	1888	0	0	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS		LIVE		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW
R	1331	887/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0
L	1331	887/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.18 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. (PLF)	VERT. LOAD (PLF)	MAX. (PLF)	MEMB.	FORCE (LBS)	MAX. (PLF)	MEMB.	FORCE (LBS)	MAX. (PLF)	MEMB.	FORCE (LBS)
FR-TO						FR-TO			FR-TO			FR-TO	
A-B	0/38	-91.8	-91.8 0.12 (1)	10.00	0/61	0/61	0.02 (4)		C-Q	0/61	0.02 (4)		
B-C	0/23	-91.8	-91.8 0.18 (1)	10.00	0/118	0/118	0.04 (4)		D-P	0/857	0.19 (1)		
C-D	-1891/0	-91.8	-91.8 0.25 (1)	4.18	P-E	-582/0	0.49 (1)		E-N	-2/0	0.00 (1)		
D-E	-2044/0	-91.8	-91.8 0.51 (1)	4.18	N-G	-581/0	0.49 (1)		M-I	0/854	0.19 (1)		
E-F	-2043/0	-91.8	-91.8 0.25 (1)	4.18	M-H	0/119	0.04 (4)		R-C	-2148/0	0.73 (1)		
F-G	-2043/0	-91.8	-91.8 0.51 (1)	10.00	L-L	-2147/0	0.73 (1)						
G-H	-2043/0	-91.8	-91.8 0.51 (1)	10.00									
H-I	-1891/0	-91.8	-91.8 0.18 (1)	10.00									
I-J	0/23	-91.8	-91.8 0.12 (1)	10.00									
J-K	0/38	-91.8	-91.8 0.12 (1)	10.00									
R-B	-259/0	0.0	0.0 0.03 (1)	7.81									
L-J	-259/0	0.0	0.0 0.03 (1)	7.81									
R-Q	0/1484	-18.5	-18.5 0.36 (1)	10.00									
Q-P	0/1493	-18.5	-18.5 0.37 (1)	10.00									
P-O	0/2044	-18.5	-18.5 0.39 (1)	10.00									
O-N	0/2044	-18.5	-18.5 0.39 (1)	10.00									
N-M	0/1493	-18.5	-18.5 0.37 (1)	10.00									
M-L	0/1464	-18.5	-18.5 0.36 (1)	10.00									

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBCC 2010, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.08")
 CALCULATED VERT. DEFL. (LL) = L/999 (0.09")
 ALLOWABLE DEFL. (TL) = L/360 (1.08")
 CALCULATED VERT. DEFL. (TL) = L/999 (0.17")

CSI: TC=0.52/1.00 (D-E); BC=0.38/1.00 (N-P); WB=0.73/1.00 (L-L); SS=0.24/1.00 (D-E);

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1887 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 6.0 Deg.

SI GRIP = 0.88 (P) (INPUT = 0.90)
 SI METAL = 0.84 (I) (INPUT = 1.00)

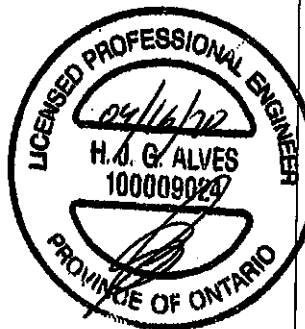


Structural component only
 DWG# T-2006185

JOB NAME 408157	TRUSS NAME T5	QUANTITY 7	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	-------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Wed Apr 15 12:13:29 2020 Page 1
ID:7R4Dg_C9IAuIONuKpIv7nzzlwO4-w8lYk7e9fioR7jkZHR7Q8JZMamYtv8OaKQUIMqzQUhK
Scale = 1:52.8

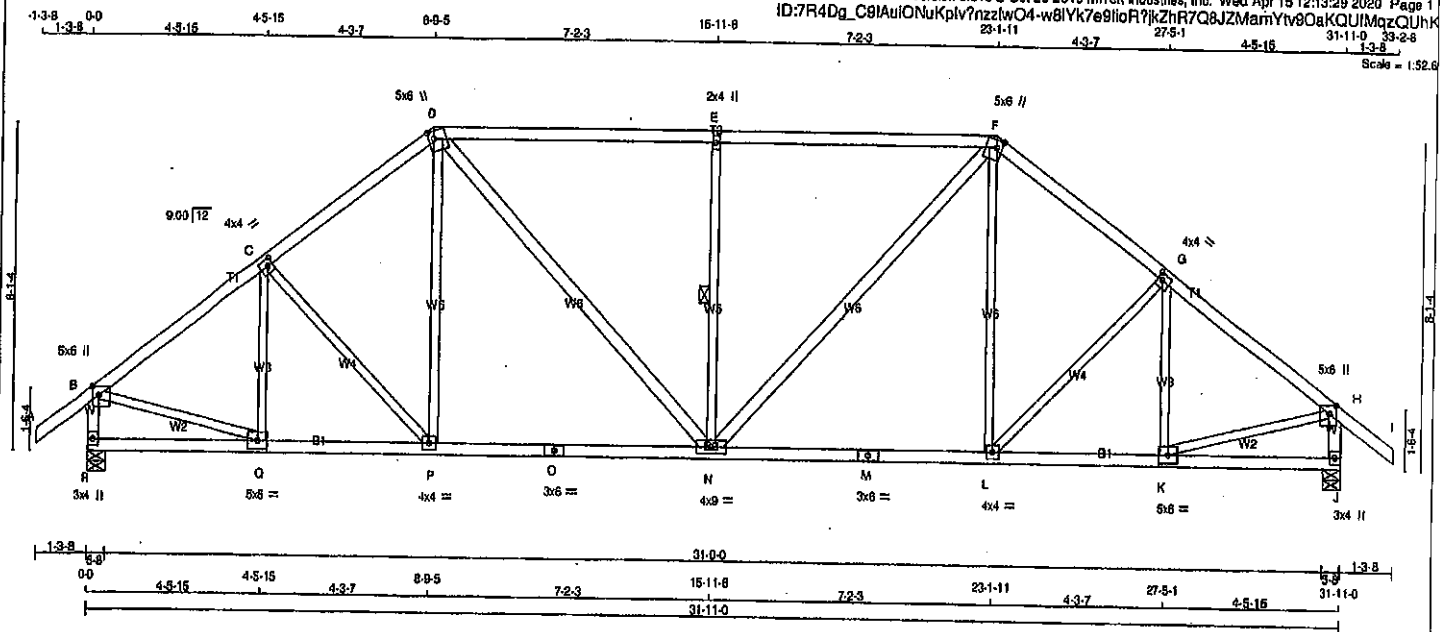

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - I	2x4	DRY No.2	SPF
R - B	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
R - O	2x4	DRY No.2	SPF
O - M	2x4	DRY No.2	SPF
M - J	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			
D - N	2x4	DRY No.2	SPF
N - F	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMVW+p	MT20	5.0	6.0	2.50 2.00
C TMVW-l	MT20	4.0	4.0	2.00 1.50
D TTWW+m	MT20	5.0	6.0	2.25 1.50
E TMVW+w	MT20	2.0	4.0	
F TTWW+m	MT20	5.0	6.0	2.25 1.50
G TMVW-l	MT20	4.0	4.0	2.00 1.50
H TMVW+p	MT20	5.0	6.0	2.50 2.00
J BMV1+p	MT20	3.0	4.0	
K BMVW-l	MT20	5.0	6.0	
L BMVW-l	MT20	4.0	4.0	
M BS-l	MT20	3.0	6.0	
N BMVW-w-l	MT20	4.0	9.0	
O BS-l	MT20	3.0	6.0	
P BMVW-l	MT20	4.0	4.0	
Q BMVW-l	MT20	5.0	6.0	
R BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
	FACTORED	MAXIMUM FACTORED	INPUT	RECORD					
	GROSS REACTION	GROSS REACTION	BRG	BRG					
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
R	1886	0	1886	0	0	5-8	5-8		
J	1886	0	1886	0	0	5-8	5-8		
UNFACTORED REACTIONS									
	1ST CASE	MAX/MIN	COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
R	1331	887 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0		
J	1331	887 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.
1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS									
MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED	FACTORED
	FORCE	(PLF)			CSI (LC)	UNBRAC		FORCE	MAX
	(LBS)					LENGTH		(LBS)	CSI (LC)
FR-TO		FROM	TO				FR-TO		
A-B	0 / 38	-91.8	-91.8	0.12 (1)	10.00		Q-C	-332 / 0	0.12 (1)
B-C	-1894 / 0	-91.8	-91.8	0.27 (1)	4.84		C-P	-138 / 0	0.10 (1)
C-D	-1835 / 0	-91.8	-91.8	0.27 (1)	4.71		P-D	0 / 212	0.05 (4)
D-E	-1881 / 0	-91.8	-91.8	0.69 (1)	4.00		D-N	0 / 844	0.10 (1)
E-F	-1881 / 0	-91.8	-91.8	0.69 (1)	4.00		N-E	-810 / 0	0.34 (1)
F-G	-1835 / 0	-91.8	-91.8	0.27 (1)	4.71		N-F	0 / 844	0.10 (1)
G-H	-1894 / 0	-91.8	-91.8	0.27 (1)	4.84		L-F	0 / 212	0.05 (4)
H-I	0 / 38	-91.8	-91.8	0.12 (1)	10.00		L-G	-138 / 0	0.10 (1)
R-B	-1848 / 0	0.0	0.0	0.19 (1)	6.18		K-G	-332 / 0	0.12 (1)
J-H	-1848 / 0	0.0	0.0	0.19 (1)	6.18		Q-Q	0 / 1591	0.36 (1)
							K-H	0 / 1591	0.36 (1)
R-Q	0 / 0	-18.5	-18.5	0.08 (4)	10.00				
Q-P	0 / 1537	-18.5	-18.5	0.32 (1)	10.00				
P-O	0 / 1445	-18.5	-18.5	0.34 (1)	10.00				
O-N	0 / 1445	-18.5	-18.5	0.34 (1)	10.00				
N-M	0 / 1445	-18.5	-18.5	0.34 (1)	10.00				
M-L	0 / 1445	-18.5	-18.5	0.34 (1)	10.00				
L-K	0 / 1537	-18.5	-18.5	0.32 (1)	10.00				
K-J	0 / 0	-18.5	-18.5	0.08 (4)	10.00				

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.0 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF
SPACING	= 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015


THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014
(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (1.06")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")
CSK: TC=0.69/1.00 (E-F:1), BC=0.34/1.00 (N-P:1), WB=0.38/1.00 (B-Q:1), SS=0.32/1.00 (E-F:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10
COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
(PSI)	(PLI)	(PLI)			
	MAX	MIN	MAX	MIN	MAX
MT20	618	354	1667	788	1987


PLATE PLACEMENT TOL = 0.250 inches
PLATE ROTATION TOL = 5.0 Deg.
JSI GRIP = 0.90 (B) (INPUT = 0.90)
JSI METAL = 0.53 (C) (INPUT = 1.00)

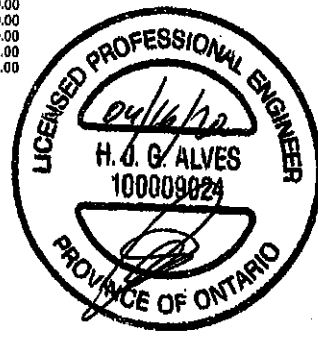

Structural component only
DWG# T-2006186

JOB NAME 408157	TRUSS NAME T6	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TAMARACK ROOF TRUSS, BURLINGTON					

Version 8.310 S Oct 28 2019 Mitek Industries, Inc. Wed Apr 15 12:13:30 2020 Page 1
ID:7R4Dg_C9AuIONuKpW7nzzwO4-OKJwTfnW7wldJf8ethX6bFAvbecalY4DDuHzQUhh

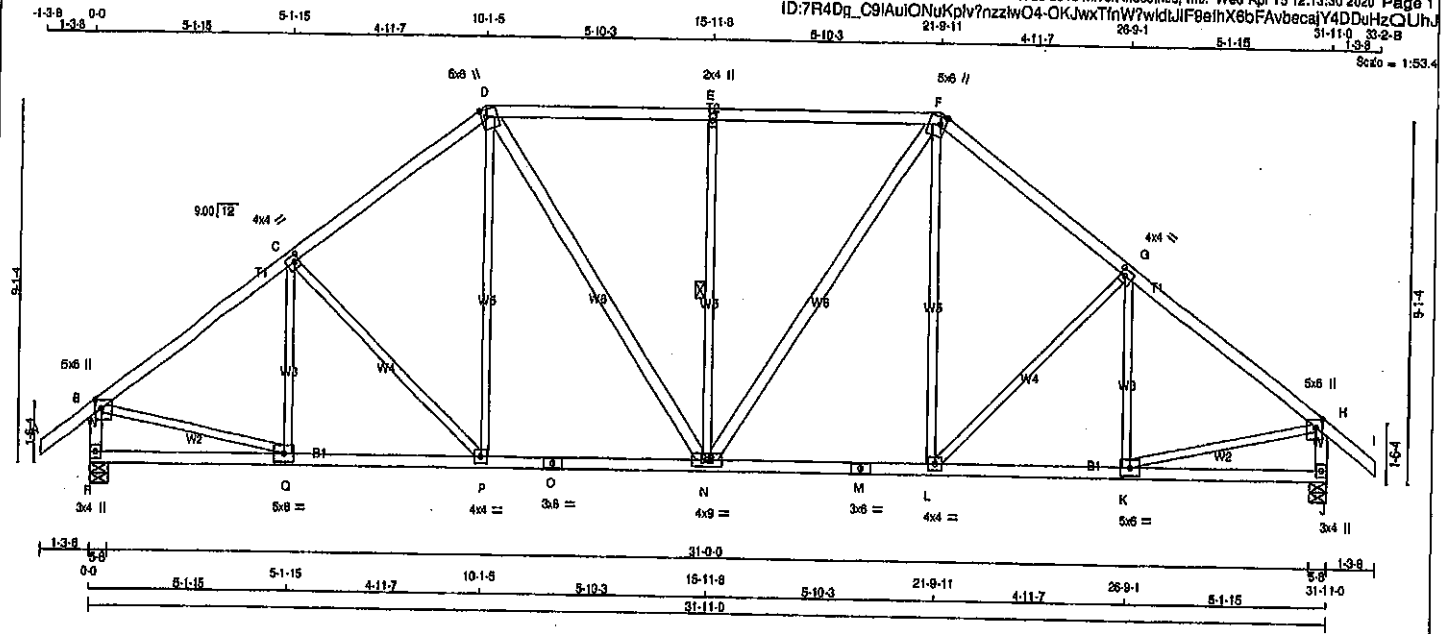

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMW+p	MT20	5.0	6.0	2.50 2.00
C	TMW-w	MT20	4.0	4.0	2.00 1.50
D	TTW+w	MT20	5.0	6.0	2.25 1.50
E	TMW+w	MT20	2.0	4.0	
F	TTW+w	MT20	5.0	6.0	2.25 1.50
G	TMW-w	MT20	4.0	4.0	2.00 1.50
H	TMW+p	MT20	5.0	6.0	2.50 2.00
J	BMV+p	MT20	3.0	4.0	
K	BMW-w	MT20	5.0	6.0	
L	BMW-w	MT20	4.0	4.0	
M	BS-1	MT20	3.0	6.0	
N	BMWW-w	MT20	4.0	9.0	
O	BS-1	MT20	3.0	6.0	
P	BMW-w	MT20	4.0	4.0	
Q	BMW-w	MT20	5.0	6.0	
R	BMV+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORIZ	DOWN	HORIZ	UPLIFT	IN-SK	IN-SK	BRG
R	1888	0	1888	0	0	0	5-8	5-8	
J	1888	0	1888	0	0	0	5-8	5-8	

UNFACTORED REACTIONS		1ST CASE		MAX/MIN COMPONENT REACTIONS		LIVE		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW
R	1331	987/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	444/0	0/0	0/0	0/0
J	1331	987/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	444/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.51 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	MAX. CSI (LC)
FR-TO				FR-TO			
A-B	0/38	-91.8	-91.8 0.12 (1)	Q-C	-262/0	0.11 (1)	
B-C	-1924/0	-91.8	-91.8 0.37 (1)	C-P	-258/0	0.25 (1)	
C-D	-1787/0	-91.8	-91.8 0.35 (1)	P-D	0/282	0.06 (1)	
D-E	-1642/0	-91.8	-91.8 0.44 (1)	D-N	0/459	0.07 (1)	
E-F	-1642/0	-91.8	-91.8 0.44 (1)	N-E	-658/0	0.35 (1)	
F-G	-1787/0	-91.8	-91.8 0.35 (1)	N-F	0/459	0.07 (1)	
G-H	-1924/0	-91.8	-91.8 0.37 (1)	L-F	0/282	0.06 (1)	
H-I	0/38	-91.8	-91.8 0.12 (1)	L-Q	-258/0	0.25 (1)	
R-B	-1845/0	0.0	0.0 0.19 (1)	K-Q	-262/0	0.11 (1)	
J-H	-1845/0	0.0	0.0 0.19 (1)	B-Q	0/1807	0.36 (1)	
				K-H	0/1807	0.36 (1)	
R-Q	0/0	-18.5	-18.5 0.11 (4)				
Q-P	0/1565	-18.5	-18.5 0.31 (1)				
P-O	0/1388	-18.5	-18.5 0.29 (1)				
O-N	0/1388	-18.5	-18.5 0.29 (1)				
N-M	0/1388	-18.5	-18.5 0.29 (1)				
M-L	0/1388	-18.5	-18.5 0.29 (1)				
L-K	0/1585	-18.5	-18.5 0.31 (1)				
K-J	0/0	-18.5	-18.5 0.11 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2015, OSO 2012, ABC 2019
- PART 9 OF OSO 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (1.08")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.13")

CSI: TC=0.44/1.00 (D-E:1), SC=0.31/1.00 (K-L:1), WB=0.39/1.00 (H-K:1), SSI=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 384 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

SI GRIP= 0.89 (B) (INPUT = 0.90)
SI METAL= 0.44 (C) (INPUT = 1.00)

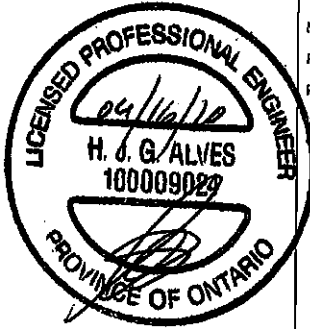


Structural component only
DWG# T-2006187

JOB NAME 408157	TRUSS NAME T7S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 2019 Mitek Industries, Inc. Wed Apr 15 12:13:31 2020 Page 1
ID:7R4Dn_C8IAuIONuKplv7nzzlwO4-sXii9pgQHJ28F1uyys9uDKfQ3aEHN3OlnkzmQizQUHl

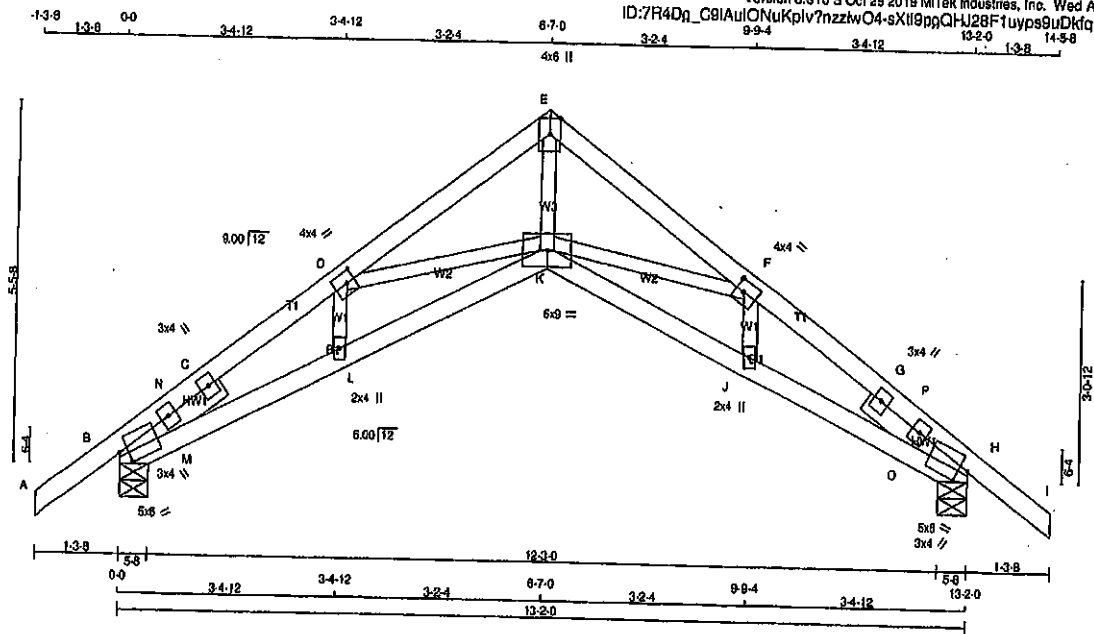

Scale: 3/8"=1'

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - E	2x4	DRY	No.2
E - I	2x4	DRY	No.2
B - K	2x4	DRY	No.2
K - H	2x4	DRY	No.2

REINFORCING MEMBERS

MEMBER	SIZE	LUMBER	DESCR.
HW1	2x4	DRY	No.2
HW2	2x4	DRY	No.2

ALL WEBS 2x3 DRY

DRY: SEASONED LUMBER.

PLATES (tablets in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMBM1-I	MT20	6.0	6.0	2.75	1.50
B, B, H, H						
D	RT-1	MT20	3.0	4.0		
E	TMWW-1	MT20	4.0	4.0	2.00	1.50
F	ITW+p	MT20	4.0	6.0	Edge	
H	TMWW-1	MT20	4.0	4.0	2.00	1.50
J	TMBM1-I	MT20	5.0	6.0	2.75	1.50
K	BMW+w	MT20	2.0	4.0		
L	BBWWW-p	MT20	6.0	9.0		
	BMW+w	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
B	852	0	852	0	5-8	5-8
H	852	0	852	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
B	600	407 / 0	0 / 0	0 / 0	0 / 0	193 / 0	0 / 0
H	600	407 / 0	0 / 0	0 / 0	0 / 0	193 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.15 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 26	-91.8 -91.8	0.12 (1)	10.00	K-E	0 / 1448	0.39 (1)
B-N	-1620 / 0	-91.8 -91.8	0.07 (1)	5.15	K-F	-230 / 0	0.05 (1)
N-C	-1389 / 0	-91.8 -91.8	0.17 (1)	5.35	J-F	-20 / 41	0.01 (4)
C-D	-1389 / 0	-91.8 -91.8	0.17 (1)	5.35	D-K	-230 / 0	0.05 (1)
D-E	-1454 / 0	-91.8 -91.8	0.18 (1)	5.25	L-D	-20 / 41	0.01 (4)
E-F	-1454 / 0	-91.8 -91.8	0.18 (1)	5.25	M-N	0 / 828	0.00 (1)
F-G	-1389 / 0	-91.8 -91.8	0.17 (1)	5.35	M-C	-937 / 0	0.10 (1)
G-P	-1389 / 0	-91.8 -91.8	0.17 (1)	5.35	C-P	0 / 828	0.00 (1)
P-H	-1620 / 0	-91.8 -91.8	0.07 (1)	5.15	O-G	-937 / 0	0.10 (1)
H-I	0 / 26	-91.8 -91.8	0.12 (1)	10.00			
B-M	0 / 1174	-18.5 -18.5	0.28 (1)	10.00			
M-L	0 / 1537	-18.5 -18.5	0.34 (1)	10.00			
L-K	0 / 1588	-18.5 -18.5	0.34 (1)	10.00			
K-J	0 / 1588	-18.5 -18.5	0.34 (1)	10.00			
J-O	0 / 1537	-18.5 -18.5	0.34 (1)	10.00			
O-H	0 / 1174	-18.5 -18.5	0.28 (1)	10.00			

TOTAL WEIGHT = 2 X 52 = 105 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.44")
CALCULATED VERT. DEFL. (LL) = $L/989$ (0.08")
ALLOWABLE DEFL. (TL) = $L/360$ (0.44")
CALCULATED VERT. DEFL. (TL) = $L/989$ (0.15")

CSK TC=0.18/1.00 (E-F-1), BC=0.34/1.00 (J-K-1), WB=0.33/1.00 (E-K-1), SS=0.28/1.00 (F-P-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1687 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.72 (K) (INPUT = 0.80)
JSI METAL= 0.60 (H) (INPUT = 1.00)

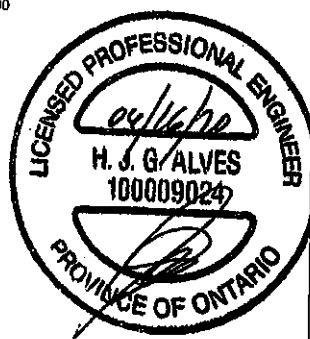


Structural component only
DWG# T-2006188

Tamarack Roof Truss, Burlington

Version 8.310 S Col 29 2019 MITek Industries, Inc. Wed Apr 15 12:13:32 2020 Page 1
ID:7R4Dg_C9IAuIOuNuKpIv?nzzhwO4-KjRpM8p22dA?bBT8Mag7myB?Pzc26XW00OJy9zQUhH

Scale = 1:38.6

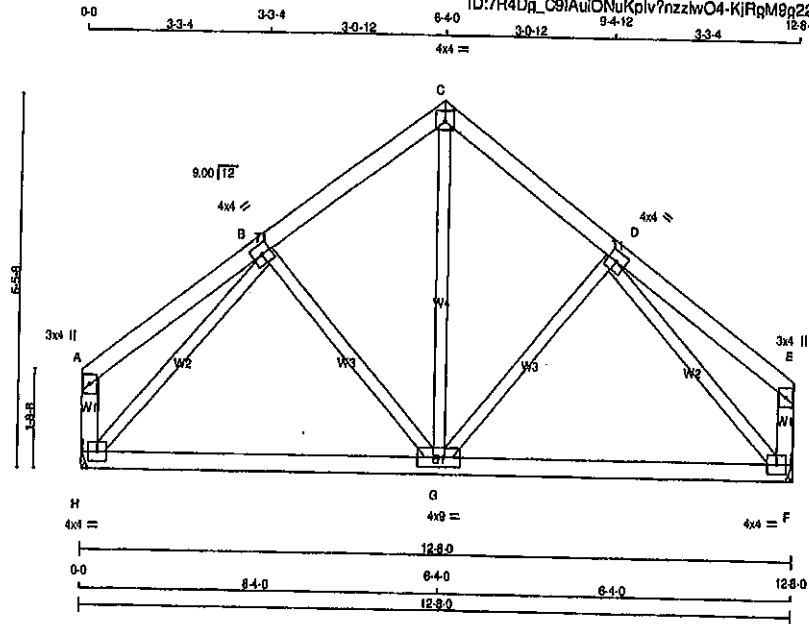

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - A	2x4	DRY	No.2
F - E	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMV+p	MT20	3.0	4.0
B	TMVW-I	MT20	4.0	4.0
C	TTW-p	MT20	4.0	4.0
D	TMVW-I	MT20	4.0	4.0
E	TMV+p	MT20	3.0	4.0
F	BMVW-I	MT20	4.0	4.0
G	BMVWV-I	MT20	4.0	4.0
H	BMVW-I	MT20	4.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

SPF	FACTORED		MAXIMUM FACTORED			INPUT	REQD
SPF	GROSS REACTION		GROSS REACTION			BRG	BRG
SPF	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
SPF	698	0	698	0	0	MECHANICAL	
SPF	698	0	698	0	0	MECHANICAL	

A SUITABLE HANGER MECHANICAL CONNECTION IS REQUIRED AT JOINT H. F. MINIMUM BEARING LENGTH AT JOINT H = 1-8, JOINT F = 1-8.

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	494	324 / 0	0 / 0	0 / 0	0 / 0	170 / 0	0 / 0
F	494	324 / 0	0 / 0	0 / 0	0 / 0	170 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: {4}

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM-TO		FR-TO			
A-B	0/20	-91.8	-91.8 0.14 (1)	10.00	G-C	0/334	0.08 (1)
B-C	-488/0	-91.8	-91.8 0.11 (1)	8.25	G-D	-125/0	0.05 (1)
C-D	-688/0	-91.8	-91.8 0.11 (1)	8.25	G-E	-125/0	0.05 (1)
D-E	0/20	-91.8	-91.8 0.14 (1)	10.00	H-B	-708/0	0.27 (1)
H-A	-111/0	0.0	0.0 0.01 (1)	7.81	D-F	-708/0	0.27 (1)
F-E	-111/0	0.0	0.0 0.01 (1)	7.81			
H-G	0/458	-18.5	-18.5 0.25 (4)	10.00			
G-F	0/458	-18.5	-18.5 0.25 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	=	25.8 PSF
	DL	=	8.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.4 PSF
TOTAL LOAD		=	39.0 PSF

SPACING 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ORC 2012, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.42")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.42")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.04")

CSI: TC=0.14/1.00 (D-E:1), EC=0.25/1.00 (G-H:4),
WB=0.27/1.00 (D-F:1), SSI=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP (DRY) (P8I)		SHEAR (PLI)		SECTION (PL)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	818	354	1887	788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.77 (B) (INPUT = 0.80)
JSI METAL= 0.26 (D) (INPUT = 1.00)




Structural component only
DWG# T-2006189

JOB NAME 408157	TRUSS NAME T9	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 12:13:33 2020 Page 1
ID:7R4Dq_C9IAu/ONuKplv?nzzlwO4-pv?3aVhgpwlsUL2KwHBMJ9k8nNz4r1x9F2StVczQUHg

Scale = 1:31.3

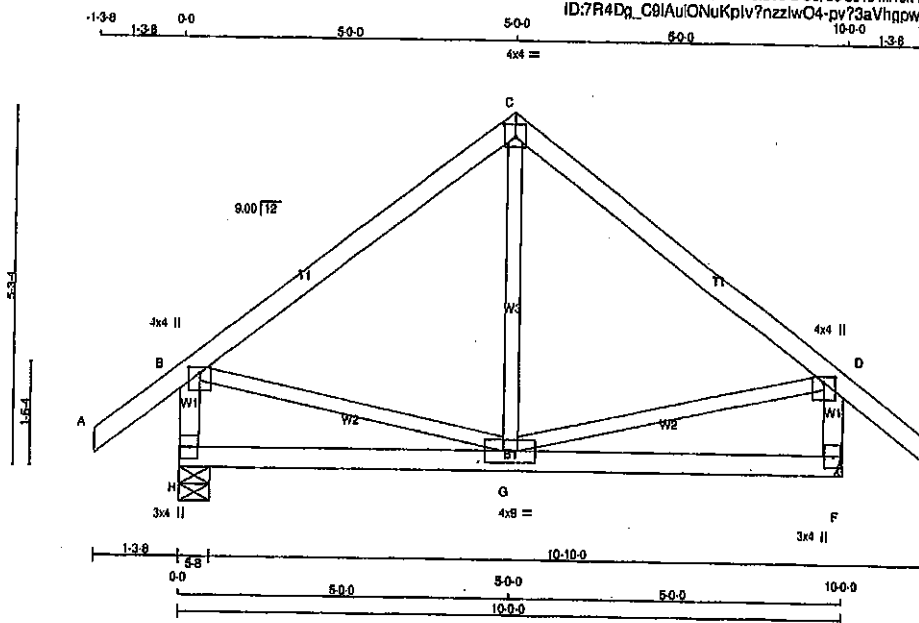

CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - D	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 EXCEPT.

DRY: SEASONED LUMBER.

DESCR.
SPF
SPF
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
H	878	0	878	0
F	878	0	878	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1'-8".

UNFACTORED REACTIONS

JT	1ST LOASE	MAX. MIN. COMPONENT REACTIONS
	COMBINED	SNOW
H	477	328/0
F	477	328/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO	CSI (LC)	FR-TO		CSI (LC)	
A-B	0/38	-91.8 -91.8	0.12 (1)	10.00	G-C	-24/77	
B-C	-382/0	-91.8 -91.8	0.30 (1)	8.25	B-G	0/298	
C-D	-382/0	-91.8 -91.8	0.30 (1)	8.25	G-D	0/298	
D-E	0/38	-91.8 -91.8	0.12 (1)	10.00			
H-B	-642/0	0.0 0.0	0.07 (1)	7.81			
F-D	-642/0	0.0 0.0	0.07 (1)	7.81			
H-G	0/0	-18.5 -18.5	0.13 (4)	10.00			
G-F	0/0	-18.5 -18.5	0.13 (4)	10.00			

TOTAL WEIGHT = 3 X 44 = 131 LB (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 8.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.33")
CALCULATED VERT. DEFL.(LL) = L/989 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.33")
CALCULATED VERT. DEFL.(TL) = L/989 (0.02")

CSI: TC=0.30/1.00 (C-D:1), BC=0.13/1.00 (F-G:4),
WB=0.07/1.00 (B-G:1), SS=0.14/1.00 (C-D:1)

DDL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR SECTION (PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1887 788	1887 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.59 (D) (INPUT = 0.90)
JSI METAL= 0.15 (D) (INPUT = 1.00)



Structural component only
DWG# T-2006190

Tamarack Roof Truss, Burlington



Structural component only
DWG# T-2006198

SPF
SPF
SPF
SPF
SPF
SPF

SPF

SPF

1ST LCASE MAX./MIN. COMPONENT REACTIONS

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.84 FT

TOTAL LOAD CASES: {4}

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN
D	9-1-8	-200	-200	...	BACK	VERT	TOTAL	...	C1
K	10-1-8	-1083	-1083	...	BACK	VERT	TOTAL	...	C1
L	10-11-4	-17	-17	...	BACK	VERT	TOTAL	...	C1

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	8.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.43")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.03")
ALLOWABLE DEFL.(TL) = $L/360$ (0.43")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.06")

CSI: TC=0.53/1.00 (C-D:1), BC=0.49/1.00 (G-H:1),
WB=0.31/1.00 (E-H:1), SSI=0.59/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (D) (INPUT = 0.90)
JSI METAL= 0.34 (E) (INPUT = 1.00)

Structural component only
DWG# T-2006191

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408157	T11	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Wed Apr 15 12:13:35 2020 Page 1
ID:7R4Dg_C9iAuiONuKplv?nzzW04-II6p_AjwLYYajScI1EqCapSTBdTJxySiMxzZUzQUhE

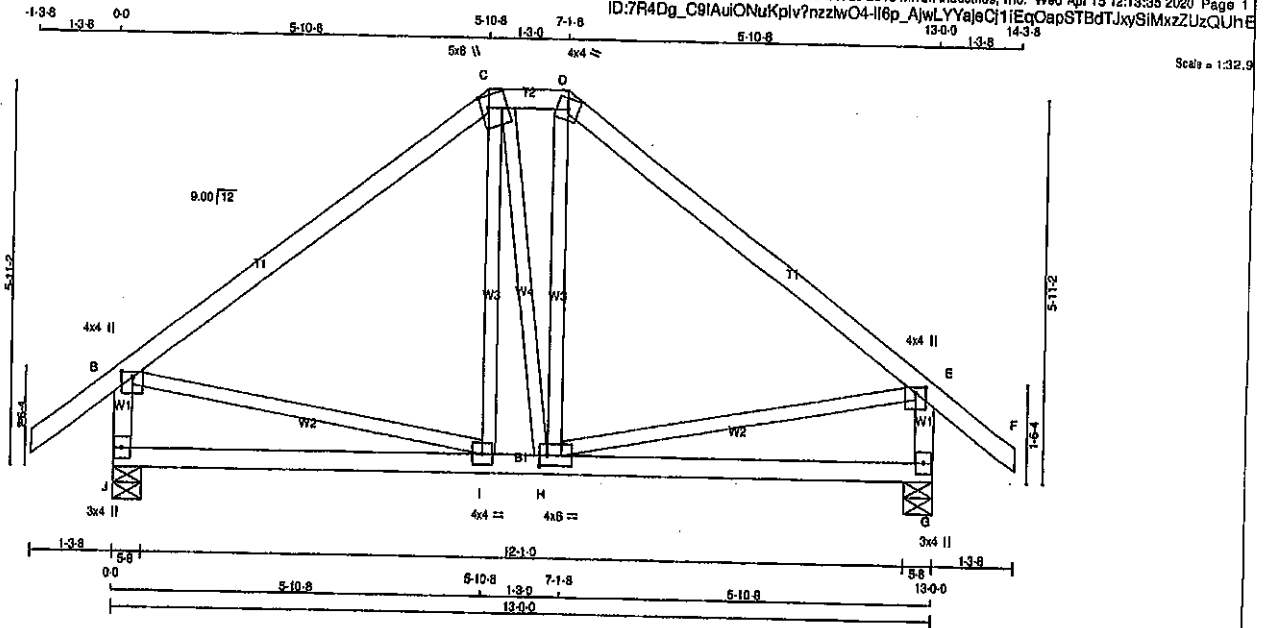

Scale = 1:32.9

LUMBER	N. L. & A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
J - B	2x4	DRY	No.2	SPF	
G - E	2x4	DRY	No.2	SPF	
J - G	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMVW+p	MT20	4.0	4.0	1.00	2.00
G	BMV1+p	MT20	3.0	4.0		
H	BMWWW-t	MT20	4.0	8.0	2.00	1.50
I	BMWW-t	MT20	4.0	4.0		
J	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
J	843	0	843	0
G	843	0	843	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	594	403 / 0	0 / 0	0 / 0	0 / 0	0 / 0	191 / 0	0 / 0
G	594	403 / 0	0 / 0	0 / 0	0 / 0	0 / 0	191 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD LO1	MEMB.	FORCE
	(LBS)	(PLF)		(LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 / 38	-91.8 -91.8	I-C	-12 / 48
B-C	-529 / 0	-91.8 -91.8	C-H	0 / 7
C-D	-423 / 0	-91.8 -91.8	H-D	-3 / 55
D-E	-530 / 0	-91.8 -91.8	B-I	0 / 431
E-F	0 / 38	-91.8 -91.8	H-E	0 / 431
J-B	-788 / 0	0.0 0.0		
G-E	-788 / 0	0.0 0.0		
J-I	0 / 0	-18.5 -18.5		
I-H	0 / 422	-18.5 -18.5		
H-G	0 / 0	-18.5 -18.5		

TOTAL WEIGHT = 62 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2015, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 085-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.43")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.43")
CALCULATED VERT. DEFL. (TL) = L/999 (0.04")

CSI: TC=0.41/1.00 (D-E-I), BC=0.20/1.00 (H-I-4), WB=0.10/1.00 (E-H-I), SI=0.17/1.00 (D-E-I)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1650

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP = 0.78 (E) (INPUT = 0.90)
JSI METAL = 0.20 (E) (INPUT = 1.00)

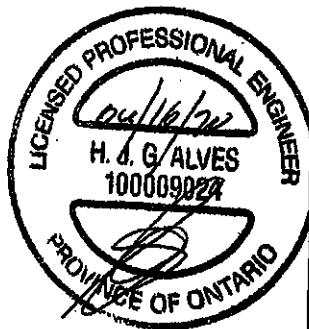

Structural component only
DWG# T-2006192

DRWG NO.	
----------	--

Scale = 1:20.2




ALL WEBS 2x3 DRY	No.2	SPF
DRY SEASONED LUMBER		

A	TYPE	PLATES	W	LEN	Y	X
J	TMVW-1	MT20	5.0	6.0		
B	TMVW+w	MT20	2.0	4.0		
C	TMVW-1	MT20	4.0	4.0		
D	TMVW-t	MT20	5.0	6.0		
E	BMV1+p	MT20	3.0	4.0		
F	BMVW-1	MT20	5.0	6.0		
G	BMVWW-t	MT20	4.0	9.0		
H	BMV1+p	MT20	3.0	4.0		

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

Structural component only
DWG# T-2006193

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408157	T13	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

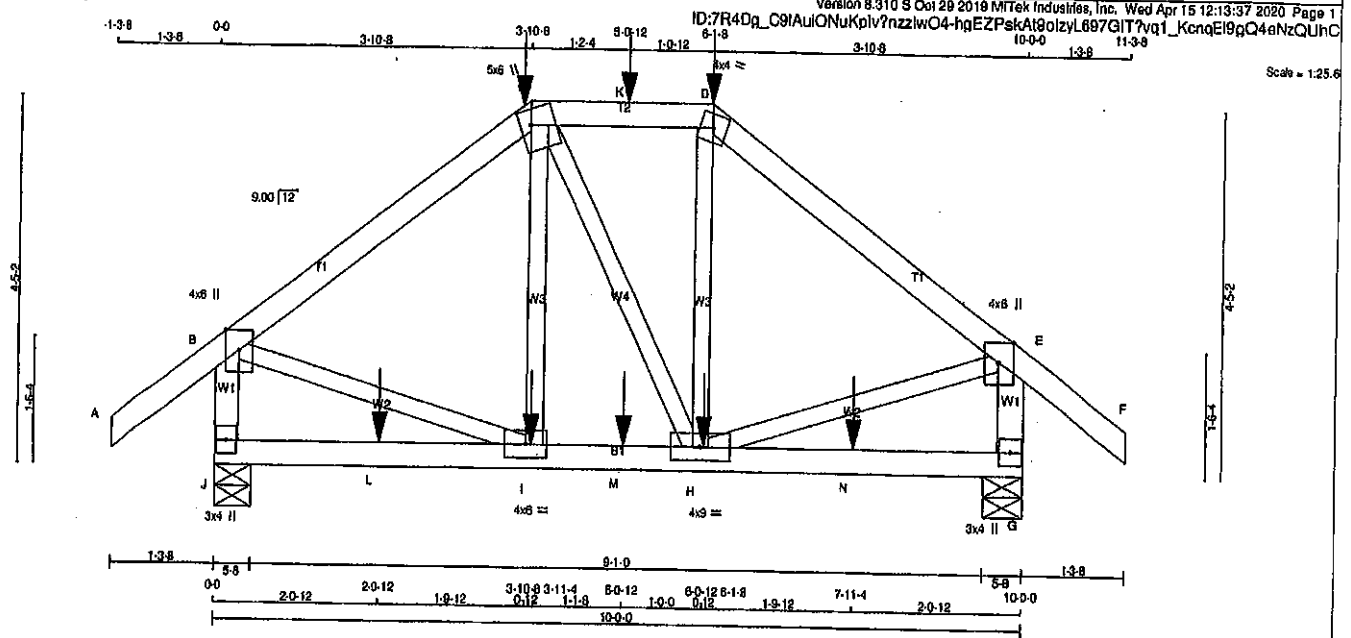

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
J - B	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF
J - G	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	8.0	Edge	
C	TTW+m	MT20	5.0	8.0	2.25	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMVW+p	MT20	4.0	8.0	Edge	
G	BMV1+p	MT20	3.0	4.0		
H	BMVWV-i	MT20	4.0	8.0		
I	BMVWV-i	MT20	4.0	8.0		
J	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	REQD BRG IN-SX
JT VERT	1058	0	0	0
JT HORZ	0	1058	0	0
G VERT	1058	0	0	0
G HORZ	0	1058	0	0

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE WIND	DEAD	SOIL
JT COMBINED	509 / 0	0 / 0	0 / 0	234 / 0
J	743	509 / 0	0 / 0	0 / 0
G	744	510 / 0	0 / 0	234 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.23 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED HORZ. LOAD (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)
FR-TO						FR-TO			
A-B	0 / 38	-91.8	-91.8	0.14 (1)	10.00	I-C	-105 / 44	0.03 (1)	0.03 (1)
B-C	-847 / 0	-91.8	-91.8	0.28 (1)	6.23	C-H	0 / 2	0.00 (4)	0.00 (4)
C-K	-874 / 0	-91.8	-91.8	0.17 (1)	6.25	H-D	-108 / 45	0.03 (1)	0.03 (1)
K-D	-874 / 0	-91.8	-91.8	0.17 (1)	6.25	D-I	0 / 706	0.17 (1)	0.17 (1)
D-E	-848 / 0	-91.8	-91.8	0.28 (1)	6.23	E-H	0 / 707	0.17 (1)	0.17 (1)
E-F	0 / 38	-91.8	-91.8	0.14 (1)	10.00				
J-B	-1018 / 0	0.0	0.0	0.12 (1)	7.74				
G-E	-1018 / 0	0.0	0.0	0.12 (1)	7.74				
J-L	0 / 0	-18.5	-18.5	0.10 (4)	10.00				
L-I	0 / 0	-18.5	-18.5	0.10 (4)	10.00				
I-M	0 / 674	-18.5	-18.5	0.18 (1)	10.00				
M-H	0 / 674	-18.5	-18.5	0.18 (1)	10.00				
H-N	0 / 0	-18.5	-18.5	0.10 (4)	10.00				
N-G	0 / 0	-18.5	-18.5	0.10 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LOC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
J	3-10-8	-293	-293	---	BACK	VERT	TOTAL	---	C1
D	8-1-8	-293	-293	---	BACK	VERT	TOTAL	---	C1
H	6-0-12	-17	-17	---	BACK	VERT	TOTAL	---	C1
I	3-11-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
K	5-0-12	-88	-88	---	BACK	VERT	TOTAL	---	C1
L	2-0-12	-17	-17	---	BACK	VERT	TOTAL	---	C1
M	5-0-12	-17	-17	---	BACK	VERT	TOTAL	---	C1
N	7-11-4	-17	-17	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 47 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
DL	= 6.0	PSF	
BOT CH.	LL	= 0.0	PSF
DL	= 7.4	PSF	
TOTAL LOAD	= 39.0	PSF	

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2018, OBC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.33')
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01')
ALLOWABLE DEFL. (TL) = $L/360$ (0.33')
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.02')

CSI: TO=0.28/1.00 (D-E:1), BC=0.16/1.00 (H-I:1), WB=0.17/1.00 (E-H:1), SI=0.13/1.00 (G-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP (DRY)	SHEAR (PL)	SECTION (PS)
MT20	818	354
MT20	1887	788
MT20	1887	1887

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.71 (E) (INPUT = 0.80)
JSI METAL= 0.46 (E) (INPUT = 1.00)

Structural component only
DWG# T-2006194

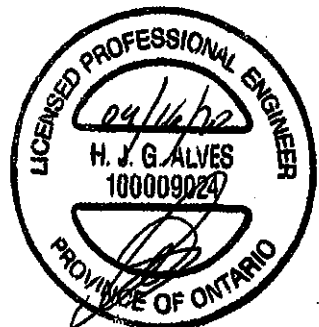

JOB NAME 408158	TRUSS NAME T21	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 16 15:04:47 2020 Page 1
ID:7R4Dg_C9IAuONuKpiv7nzzlwO4_-So2aX1BGcj63ETwn?WeikFr6uR93Z6PIUCX56zQSAK

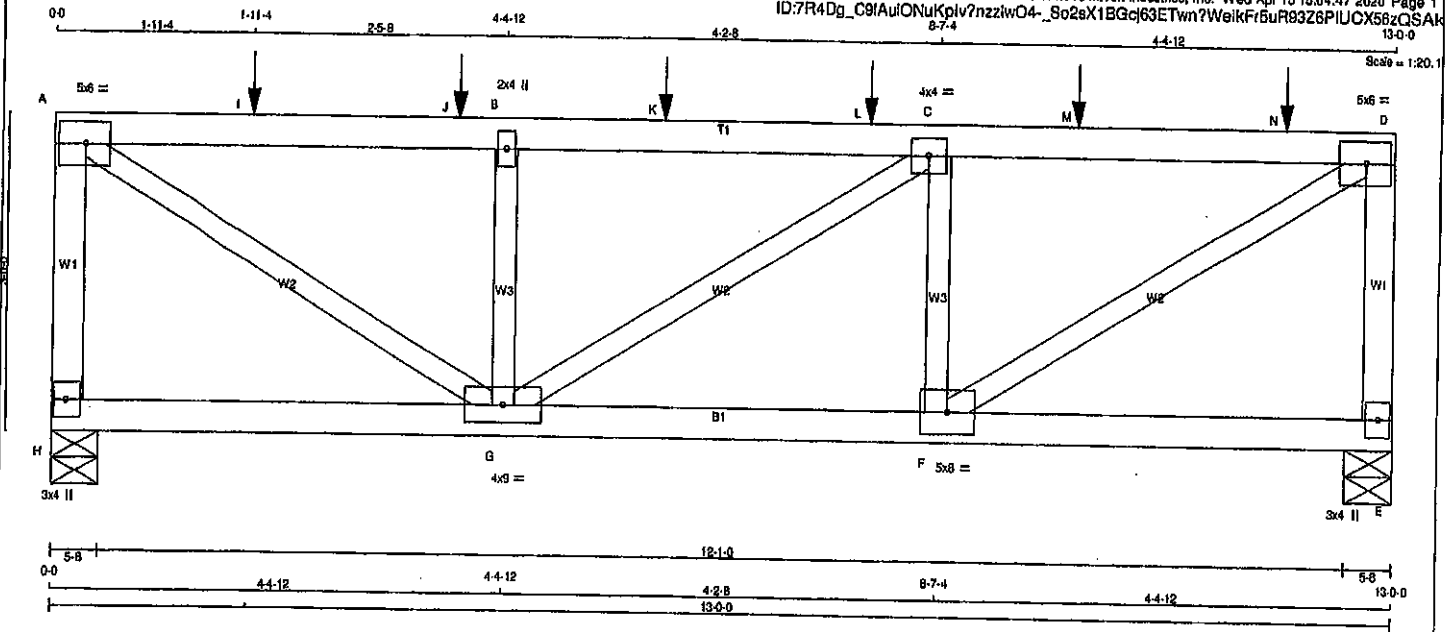

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
H - A	2x4	DRY	No.2
A - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
H - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
H-A	12	TOP
A-D	12	SIDE(0.0)
D-E	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
H-E	12	SIDE(21.0)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (tablets in inches)	PLATES	W	LEN	Y	X
JT TYPE					
A TMVW-1	MT20	5.0	8.0		
B TMVW-w	MT20	2.0	4.0		
C TMVW-1	MT20	4.0	4.0		
D TMVW-1	MT20	5.0	8.0		
E BMV1-p	MT20	3.0	4.0		
F BMVW-1	MT20	5.0	8.0		
G BMVW-1	MT20	4.0	9.0		
H BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
H	2173	0	2173	0	5-8
E	2348	0	2348	0	5-8

UNFACTORED REACTIONS		1ST CASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
H	1557	908 / 0	0 / 0
E	1680	993 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.83 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED	FACTORED	MAX	MAX	WEBS	MAX. FACTORED	MAX
MEMB.	FORCE (LBS)	VERT.	LOAD (PLF)	LC1	CS1 (LC)	MEMB.	FORCE (LBS)	CS1 (LC)
FR-TO		FROM	TO			FR-TO		
H-A	-2084 / 0	0.0	0.0	0.17 (1)	7.69	F-D	0 / 3259	0.40 (1)
A-I	-2748 / 0	-91.8	-91.8	0.48 (1)	4.89	A-G	0 / 3226	0.40 (1)
I-J	-2748 / 0	-91.8	-91.8	0.48 (1)	4.89	F-C	-1452 / 0	0.14 (1)
J-B	-2748 / 0	-91.8	-91.8	0.48 (1)	4.89	G-B	-1421 / 0	0.14 (1)
B-K	-2748 / 0	-91.8	-91.8	0.48 (1)	4.85	G-C	-34 / 0	0.01 (1)
K-L	-2748 / 0	-91.8	-91.8	0.48 (1)	4.85			
L-C	-2748 / 0	-91.8	-91.8	0.48 (1)	4.85			
C-M	-2775 / 0	-91.8	-91.8	0.48 (1)	4.83			
M-N	-2775 / 0	-91.8	-91.8	0.48 (1)	4.83			
N-D	-2775 / 0	-91.8	-91.8	0.48 (1)	4.83			
E-D	-2240 / 0	0.0	0.0	0.18 (1)	7.46			
H-G	0 / 0	-56.0	-56.0	0.12 (4)	10.00			
G-F	0 / 2775	-56.0	-56.0	0.30 (1)	10.00			
F-E	0 / 0	-56.0	-56.0	0.12 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)		LOC.	LC1	MAX	FACE	DIR.
JT						
I	1-11-4	-433	-433	---	BACK	VERT
J	3-11-4	-433	-433	---	BACK	VERT
K	5-11-4	-433	-433	---	BACK	VERT
L	7-11-4	-433	-433	---	BACK	VERT
M	9-11-4	-433	-433	---	BACK	VERT
N	11-11-4	-433	-433	---	BACK	VERT

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 51 = 101 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2010
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.43")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL) = L/360 (0.43")
CALCULATED VERT. DEFL.(TL) = L/999 (0.07")

CSI: TC=0.48/1.00 (C-D:1), BC=0.30/1.00 (F-G:1), WB=0.40/1.00 (D-F:1), SS=0.39/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (G) (INPUT = 0.80)
JSI METAL= 0.36 (G) (INPUT = 1.00)

Structural component only
DWG# T-2006199

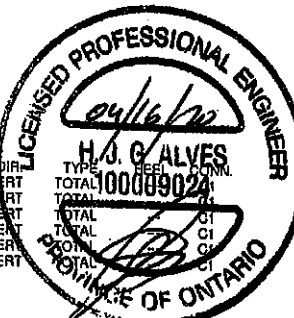

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408158	T22	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 16 15:04:48 2020 Page 1					
ID:7R4Dg_C8IAuIONuKplv7nzzlwO4-S/MR311p1wryhO28Lj1tFyo7OloGo3VYz8x5dYzQSA					
Scale = 1:23.4					

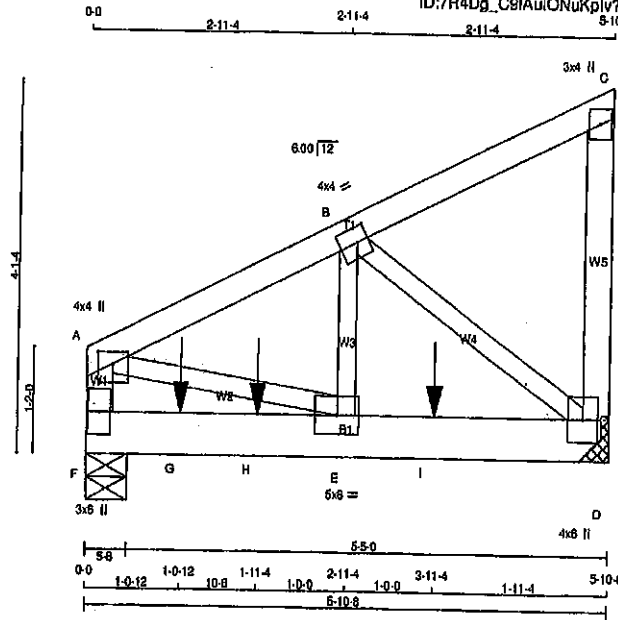

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - C	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
F - A	2x4	DRY	No.2	SPF
F - D	2x6	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	12	TOP
C-D	12	TOP
F-A	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F-D	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (Table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.50	2.00
B	TMVW-i	MT20	4.0	4.0	2.00	1.50
C	TMV+p	MT20	3.0	4.0		
D	BMVW1+p	MT20	4.0	6.0		
E	BMVW-i	MT20	5.0	6.0		
F	BMV1+p	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
D	1303	0	1303	0
F	1517	0	1517	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4'-0".

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	918	618 / 0	0 / 0	0 / 0	0 / 0	304 / 0	0 / 0
F	1069	721 / 0	0 / 0	0 / 0	0 / 0	348 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM		FR-TO			
A-B	-1491 / 0	-91.8	-91.8 0.06 (1)	8.25	E-B	0 / 1381	0.17 (1)
B-C	-10 / 0	-91.8	-91.8 0.05 (1)	8.25	B-D	-1689 / 0	0.20 (1)
D-C	-112 / 0	0.0	0.0 0.01 (1)	7.81	A-E	0 / 1388	0.17 (1)
F-A	-1137 / 0	0.0	0.0 0.08 (1)	7.81			
F-G	0 / 0	-18.5	-18.5 0.22 (1)	10.00			
G-H	0 / 0	-18.5	-18.5 0.22 (1)	10.00			
H-E	0 / 0	-18.5	-18.5 0.22 (1)	10.00			
E-I	0 / 1342	-18.5	-18.5 0.24 (1)	10.00			
I-D	0 / 1342	-18.5	-18.5 0.24 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	1-0-12	-113	-113	---	TOP	VERT	TOTAL	---	C1
H	1-11-4	-1237	-1237	---	BACK	VERT	TOTAL	---	C1
I	3-11-4	-822	-822	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D.

TOTAL WEIGHT = 2 X 29 = 58 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
DL	=	6.0	PSF	
BOY CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. O/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIG 2011, TPIG 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/380$ (0.20")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01")
ALLOWABLE DEFL. (TL) = $L/380$ (0.20")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.02")

CSI: TC=0.08/1.00 (A-F:1), BC=0.24/1.00 (D-E:1), WB=0.20/1.00 (B-D:1), SSI=0.34/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MIN	MAX	MIN
MT20	618	354
	1867	788
	1997	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.04 (A) (INPUT = 0.80)
JSI METAL = 0.30 (D) (INPUT = 1.00)



Structural component only
DWG# T-2006200

DP-104 (Rev. 1-2000) CONTINUED ON PAGE 2


JOB NAME 408158 Tamarack Roof Truss, Burlington	TRUSS NAME T23S	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--	---------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Version 8.310 S Oct 28 2018 Mittek Industries, Inc. Wed Apr 15 15:04:49 2020 Page 2
 ID:7R4Dg C9IAuIONuKpIv?nzzlwO4-wrvpHD2RoEzpJXdlvQY6n8KCBi7aXW9iCoh98_zQSA

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
T	4-3-12	-8	-8	---	FRONT	VERT	TOTAL	---	C1
U	6-3-12	-8	-8	---	FRONT	VERT	TOTAL	---	C1
V	8-3-12	-8	-8	---	FRONT	VERT	TOTAL	---	C1
W	10-3-12	-8	-8	---	FRONT	VERT	TOTAL	---	C1
X	13-2-12	-15	-15	---	FRONT	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

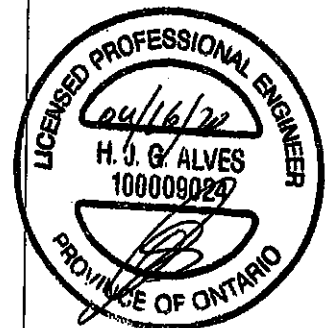

Structural component only
 DWG# T-2006201

JOB NAME 408158	TRUSS NAME T24	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

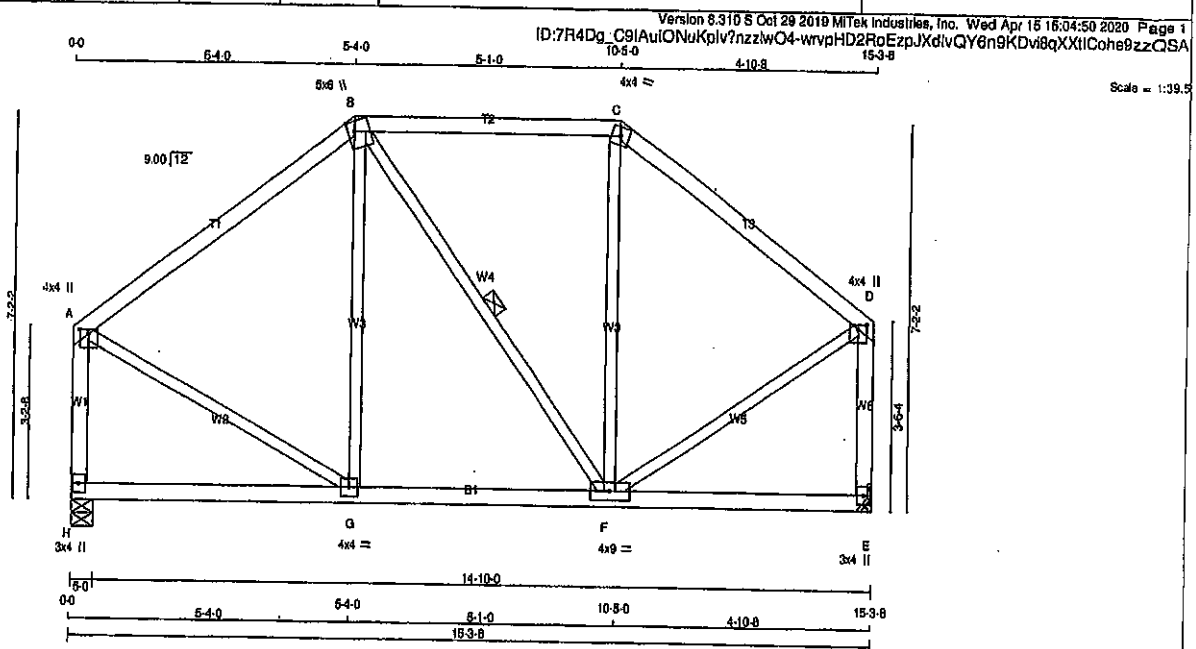

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES				
A - B	2x4	DRY	No.2	SPF
B - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
H - A	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
H - E	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
B	TTWW+m	MT20	5.0	6.0	2.25	1.50
C	TTW-m	MT20	4.0	4.0		
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
E	BMV1+p	MT20	3.0	4.0		
F	BMVWV-l	MT20	4.0	9.0		
G	BMVW-l	MT20	4.0	4.0		
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
H	841	0	841	0	5-0
E	841	0	841	0	5-0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 3'-0."

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	595	390 / 0	0 / 0	0 / 0	0 / 0	204 / 0	0 / 0
E	595	390 / 0	0 / 0	0 / 0	0 / 0	204 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF B-F.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	FR-TO	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
A-B	-542 / 0	-91.8	-91.8	0.33 (1)	6.25	G-B	-125 / 37	0.11 (1)		
B-C	-413 / 0	-91.8	-91.8	0.30 (1)	6.25	B-F	-31 / 0	0.01 (1)		
C-D	-520 / 0	-91.8	-91.8	0.28 (1)	6.25	F-G	-144 / 28	0.13 (1)		
H-A	-800 / 0	0.0	0.0	0.14 (1)	7.81	A-G	0 / 480	0.11 (1)		
E-D	-803 / 0	0.0	0.0	0.17 (1)	7.81	F-D	0 / 493	0.11 (1)		
H-G	0 / 0	-18.5	-18.5	0.12 (4)	10.00					
G-F	0 / 431	-18.5	-18.5	0.15 (4)	10.00					
F-E	0 / 0	-18.5	-18.5	0.10 (4)	10.00					

TOTAL WEIGHT = 71 lb

[M][F]

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
DL = 8.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD = 39.0	PSF	

SPACING = 24.0 IN. C/G

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.51")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.51")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.33/1.00 (A-B:1), BC=0.16/1.00 (F-G:4),
WB=0.19/1.00 (C-F:1), SS=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MT20	610	354
1687	788	1987
1656		

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

SI GRIP= 0.89 (A) (INPUT = 0.80)
SI METAL= 0.18 (A) (INPUT = 1.00)

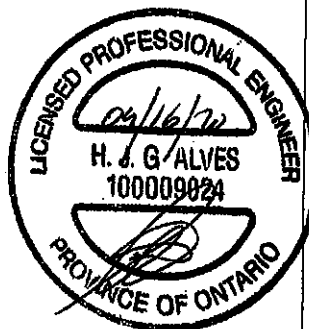

Structural component only
DWG# T-2006202


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408159	T31	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

TRUSS DESC.

Version 8.310 S Oct 29 2018 MITek Industries, Inc. Wed Apr 15 12:51:43 2020 Page 1

ID:MTW7E0QKRW7Mm2IBLF7kizlsx7-TMmBXP6WXPxDG6S4DHN64QRUVSPe8EqKA3stzGU7U



Scale = 1:52.8

CHORDS	SIZE	DRY	NO.2	DESCR.	SPF
A - C	2x4	DRY	No.2	SPF	SPF
G - F	2x4	DRY	No.2	SPF	SPF
H - J	2x4	DRY	No.2	SPF	SPF
K - I	2x4	DRY	No.2	SPF	SPF
S - B	2x8	DRY	No.2	SPF	SPF
P - N	2x8	DRY	No.2	SPF	SPF
N - K	2x8	DRY	No.2	SPF	SPF

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A - C 1 12	SIDE(81.0)	
C - F 1 12	SIDE(81.0)	
F - H 1 12	SIDE(81.0)	
H - J 1 12	SIDE(81.0)	
J - I 1 12	SIDE(81.0)	
S - B 2 12	TOP	
K - I 2 12	TOP	
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
S - P 2 12	SIDE(183.1)	
P - N 2 12	SIDE(183.1)	
N - K 2 12	SIDE(183.1)	
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1 8		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	5.0	8.0		
C	TTWW-m	MT20	6.0	9.0	2.25	3.75
D	TMVW-1	MT20	4.0	4.0		
E	TMVW-w	MT20	2.0	4.0		
F	TS-1	MT20	3.0	8.0		
G	TMVW-1	MT20	4.0	4.0		
H	TTWW-m	MT20	6.0	9.0	2.25	3.75
I	TMVW-1	MT20	5.0	8.0		
K	BMV1+p	MT20	3.0	8.0		
L	BMVW-1	MT20	5.0	8.0	2.50	2.50
M	BMVW-1	MT20	5.0	8.0	2.50	2.75
N	BS-1	MT20	5.0	8.0		
O	BMVW-1	MT20	5.0	8.0		
P	BS-1	MT20	5.0	8.0		
Q	BMVW-1	MT20	5.0	8.0	2.50	2.75
R	BMVW-1	MT20	5.0	8.0	2.50	2.50
S	BMV1+p	MT20	3.0	8.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

	FACTORED GROSS REACTION	MAXIMUM FACTORED DOWN	MAXIMUM FACTORED HORZ	INPUT IN-SX	REQD IN-SX
JT	VERT	DOWN	HORZ	UPLIFT	BRG
S	2889	0	0	5-8	5-8
K	2888	0	0	5-8	5-8

UNFACTORED REACTIONS

	18T LOOSE	MAX. MIN. LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
S	2114	1385/0	0/0	0/0	0/0	730/0
K	2114	1384/0	0/0	0/0	0/0	730/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.43 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MAX. FACTORED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORZ. LOAD (LBS)
FR-TO						FR-TO			
A-B	0/28	-91.8	-91.8	0.07 (1)	10.00	R-C	-331/42	0.04 (1)	
B-C	-4481/0	-91.8	-91.8	0.48 (1)	4.12	C-Q	0/2360	0.29 (1)	
C-T	-5884/0	-91.8	-91.8	0.49 (1)	3.80	Q-D	-1230/0	0.18 (1)	
T-U	-5884/0	-91.8	-91.8	0.49 (1)	3.80	D-O	0/674	0.08 (1)	
U-D	-5884/0	-91.8	-91.8	0.49 (1)	3.80	O-E	-678/0	0.09 (1)	
D-V	-6424/0	-91.8	-91.8	0.52 (1)	3.43	E-G	0/677	0.08 (1)	
V-W	-6424/0	-91.8	-91.8	0.52 (1)	3.43	M-G	-1229/0	0.16 (1)	
W-E	-6424/0	-91.8	-91.8	0.52 (1)	3.43	M-H	0/2368	0.29 (1)	
E-F	-6424/0	-91.8	-91.8	0.51 (1)	3.43	L-H	-331/42	0.04 (1)	
F-X	-6424/0	-91.8	-91.8	0.51 (1)	3.43	B-R	0/4021	0.50 (1)	
X-G	-6424/0	-91.8	-91.8	0.51 (1)	3.43	L-I	0/4010	0.50 (1)	
G-Y	-5881/0	-91.8	-91.8	0.48 (1)	3.61				
Y-Z	-5881/0	-91.8	-91.8	0.48 (1)	3.61				
Z-H	-5881/0	-91.8	-91.8	0.48 (1)	3.61				
H-I	-4459/0	-91.8	-91.8	0.48 (1)	4.12				
I-J	0/28	-91.8	-91.8	0.07 (1)	10.00				
S-B	-2910/0	0.0	0.0	0.10 (1)	7.81				
K-I	-2809/0	0.0	0.0	0.10 (1)	7.81				
S-AA	0/0	-18.5	-18.5	0.05 (4)	10.00				
AA-AB	0/0	-18.5	-18.5	0.05 (4)	10.00				
AB-R	0/0	-18.5	-18.5	0.05 (4)	10.00				
R-AC	0/3978	-18.5	-18.5	0.19 (1)	10.00				
AC-AD	0/3978	-18.5	-18.5	0.19 (1)	10.00				
AD-Q	0/3978	-18.5	-18.5	0.19 (1)	10.00				
Q-P	0/5884	-18.5	-18.5	0.28 (1)	10.00				
P-AE	0/5884	-18.5	-18.5	0.28 (1)	10.00				
AE-O	0/5884	-18.5	-18.5	0.28 (1)	10.00				
O-AF	0/5881	-18.5	-18.5	0.28 (1)	10.00				
AF-N	0/5881	-18.5	-18.5	0.28 (1)	10.00				
N-M	0/5881	-18.5	-18.5	0.28 (1)	10.00				
M-AG	0/3977	-18.5	-18.5	0.19 (1)	10.00				
AG-AH	0/3977	-18.5	-18.5	0.19 (1)	10.00				
AH-L	0/3977	-18.5	-18.5	0.19 (1)	10.00				
L-AI	0/0	-18.5	-18.5	0.05 (4)	10.00				
AI-AJ	0/0	-18.5	-18.5	0.05 (4)	10.00				
AJ-K	0/0	-18.5	-18.5	0.05 (4)	10.00				

JT	LOC.	LO1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-411	-411	---	FRONT	VERT	TOTAL	C1
E	15-11-8	-110	-110	---	FRONT	VERT	TOTAL	C1
F	17-11-12	-110	-110	---	FRONT	VERT	TOTAL	C1

TOTAL WEIGHT = 2 X 143 = 286 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")
CALCULATED VERT. DEFL.(LL) = L/999 (0.17")
ALLOWABLE DEFL.(TL) = L/360 (1.08")
CALCULATED VERT. DEFL.(TL) = L/999 (0.32")

CSI: TO=0.52/1.00 (D-E-1), BC=0.28/1.00 (O-Q-1), WB=0.50/1.00 (B-R-1), SS=0.19/1.00 (C-D-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.73 (L) (INPUT = 0.90)
JSI METAL= 0.65 (N) (INPUT = 1.00)

Structural component only 1/2
DWG# T-2006212

CONTINUED ON PAGE 2


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408159	T31	1	2	GREEN PARK HOMES	
Tamarack Roof Trusses, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2018 Mitek Industries, Inc. Wed Apr 15 12:31:43 2020 Page 2
ID:MTW7EQQKeRW7Mm2BLF?Kzlex7-ITMmBXP6WXXpDG6S4DHN64aQRUVSPe8EqKA3stzQU7U

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
H	25-0-8	-411	-411	---	FRONT	VERT	TOTAL	---	C1
L	25-11-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
N	18-11-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
O	18-11-8	-28	-28	---	FRONT	VERT	TOTAL	---	C1
P	11-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	19-11-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	21-11-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	23-11-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	1-11-4	-25	-28	---	FRONT	VERT	TOTAL	---	C1
AB	3-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AC	7-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AD	9-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AE	13-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AF	17-11-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AG	21-11-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AH	23-11-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AI	27-11-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AJ	29-11-12	-25	-28	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

I) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

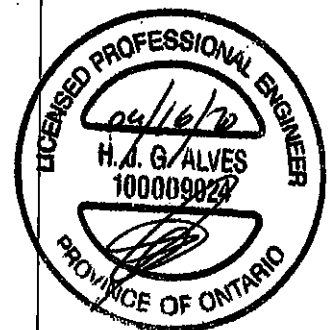


Structural component only
DWG# T-2006212

JOB NAME 408159	TRUSS NAME T31Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Wed Apr 16 12:51:45 2020 Page 2	
ID:MTW7E0QKeRW7Mm2RLP7ki2sx7-lsUXcCOM283ISZGrBgJrGVikef5VIWGXHs9xkzQU7S					

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX	MAX*	FACE	DIR.	TYPE	HEEL	CONN.
W	13-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
X	1-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
Y	3-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
Z	7-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AA	9-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AB	13-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AC	17-11-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AD	18-9-8	-1564	-1564	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

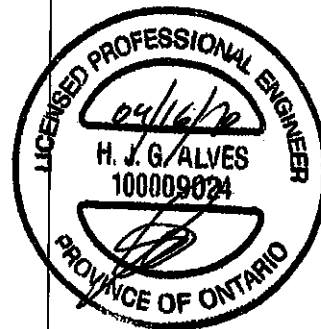

Structural component only
DWG# T-2006213


72

JOB NAME 408159	TRUSS NAME T32	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TAMARECK ROOF TRUSS, BURLINGTON					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Wed Apr 16 12:51:48 2020 Page 1

ID:MTW7E0QK6RW7Mm2fBLF?kizax?-A22vqYR_pSBW4jr1Mq4kiCkXJITKcw2gWIPITCzQU7R

Scale = 1:82.6

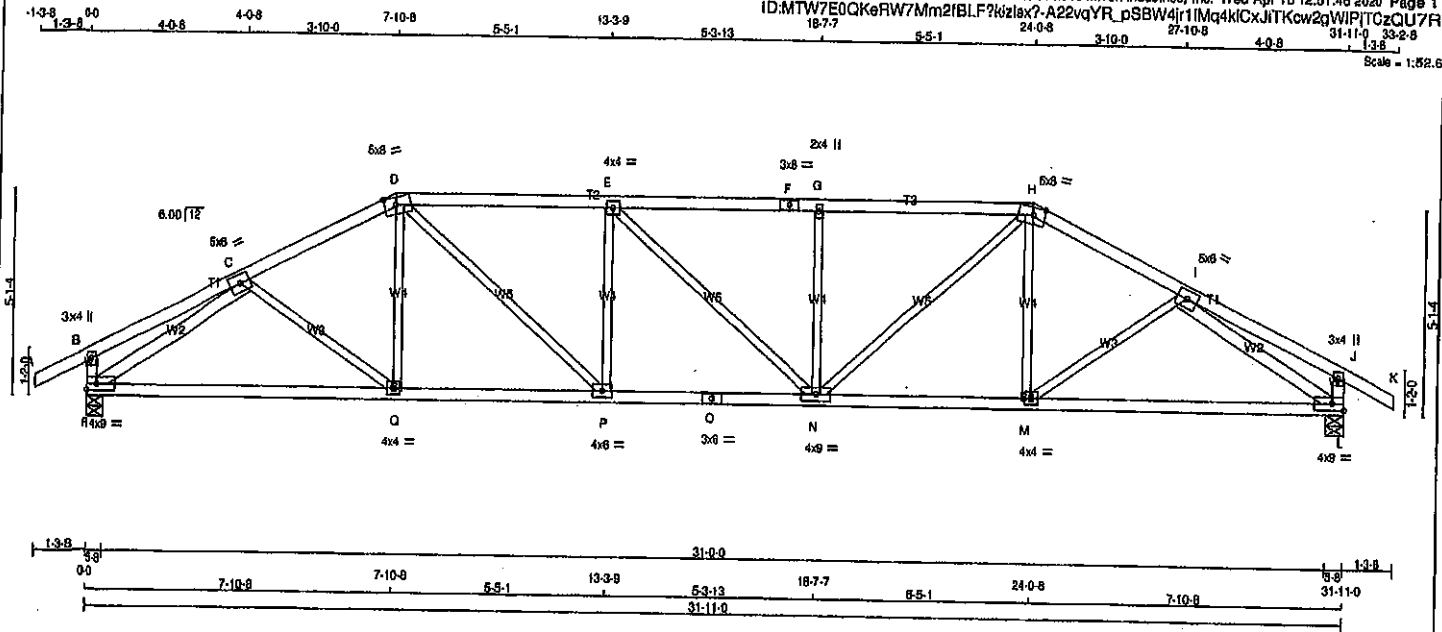

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
R - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
EXCEPT			
R - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMV-p	MT20	3.0	4.0
C	TMWW-1	MT20	5.0	8.0
D	TTWW-m	MT20	5.0	8.0
E	TMWW-1	MT20	4.0	4.0
F	TS-1	MT20	3.0	8.0
G	TMWW-m	MT20	2.0	4.0
H	TTWW-m	MT20	5.0	8.0
I	TMWW-1	MT20	5.0	8.0
J	TMV-p	MT20	3.0	4.0
L	BMWW-1	MT20	4.0	9.0
M	BMWW-1	MT20	4.0	4.0
N	BMWW-1	MT20	4.0	9.0
O	SS-1	MT20	3.0	8.0
P	BMWW-1	MT20	4.0	8.0
Q	BMWW-1	MT20	4.0	4.0
R	BMWW-1	MT20	4.0	9.0
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.				

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	HORIZ	BRG	IN-SX	BRG	IN-SX
R	1884	0	1884	0	0	5-8	5-8	5-8	5-8
L	1884	0	1884	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST LGASE		MAX/MIN COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
R	1330	888 / 0	0 / 0	0 / 0	0 / 0
L	1330	888 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.61 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0 / 28	A-B	0 / 74
B-C	0 / 17	B-C	0 / 133
C-D	-2469 / 0	C-D	0 / 933
D-E	-2893 / 0	D-E	-534 / 0
E-F	-2891 / 0	E-F	-2 / 0
F-G	-2891 / 0	F-G	-533 / 0
G-H	-2891 / 0	G-H	0 / 931
H-I	-2469 / 0	H-I	0 / 134
I-J	0 / 17	I-J	0 / 74
J-K	0 / 28	J-K	-2888 / 0
K-L	-289 / 0	K-L	-2887 / 0
L-M	-289 / 0	L-M	0 / 74
M-N	0 / 2167	M-N	-18.5 / 0.49 (1)
N-O	0 / 2194	N-O	-18.5 / 0.49 (1)
O-P	0 / 2893	O-P	-18.5 / 0.53 (1)
P-Q	0 / 2893	P-Q	-18.5 / 0.53 (1)
Q-R	0 / 2194	Q-R	-18.5 / 0.49 (1)
R-S	0 / 2167	R-S	-18.5 / 0.49 (1)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.06")
CALCULATED VERT. DEFL. (LL) = L/999 (0.15")
ALLOWABLE DEFL. (TL) = L/360 (1.06")
CALCULATED VERT. DEFL. (TL) = L/898 (0.29")

CSI: TC=0.54/1.00 (D-E-1), BC=0.53/1.00 (N-P-1), WB=0.74/1.00 (I-L-1), SS=0.23/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP (DRY)	SHEAR	SECTION	
(PSI)	(PL)	(PL)	
MAX	MIN	MAX	MIN
MT20	818	354	1887

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

SI GRIP= 0.84 (O) (INPUT = 0.90)
SI METAL= 0.84 (O) (INPUT = 1.00)

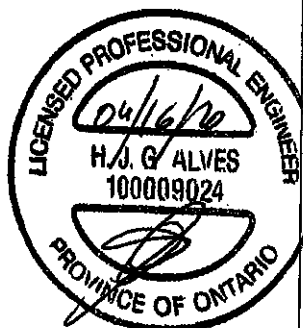


Structural component only
DWG# T-2006214

JOB NAME 408159	TRUSS NAME T33	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Wed Apr 15 12:51:47 2020 Page 1
ID:MTW7E0QKerW7Mm2IBLF7Kizlsx7-eECh7uScamJNtQDJ3LHw688z2LQply8G0ezQU7Q
Scale = 1:52.6

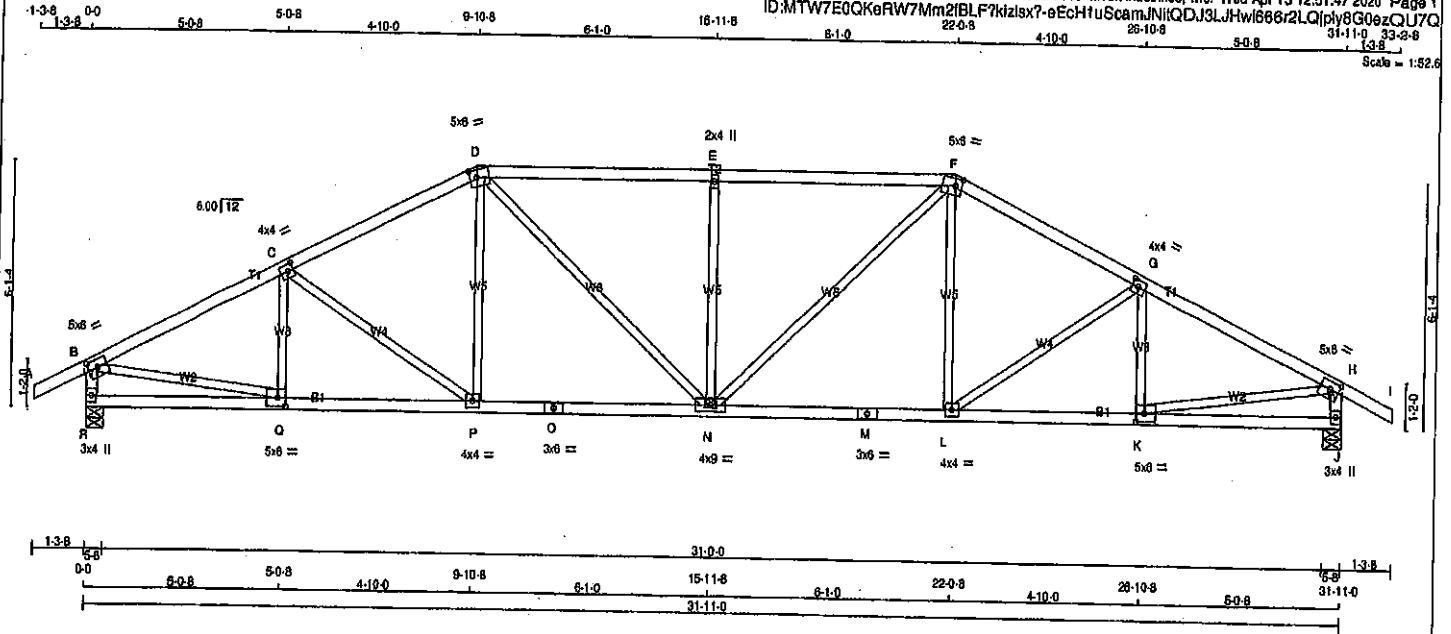

LUMBER	N. L. O. A. RULES	SIZE	LUMBER	DESCR.
CHORDS				
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
R - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
R - O	2x4	DRY	No.2	SPF
O - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
DRY, SEASONED LUMBER.				

PLATES (table in inches)	W	LEN	Y	X
JT TYPE				
B TMVW-1	MT20	5.0	6.0	2.25
C TMVW-1	MT20	4.0	4.0	2.00
D TTWW-m	MT20	5.0	6.0	2.25
E TMVW-w	MT20	2.0	4.0	
F TTWW-m	MT20	5.0	6.0	2.25
G TMVW-1	MT20	4.0	4.0	2.00
H TMVW-1	MT20	5.0	6.0	2.25
J BMV1-p	MT20	3.0	4.0	
K BMVW-1	MT20	5.0	6.0	2.50
L BMVW-1	MT20	4.0	4.0	
M BS-1	MT20	3.0	6.0	
N BMVWW-1	MT20	4.0	9.0	
O BS-1	MT20	3.0	6.0	
P BMVW-1	MT20	4.0	4.0	
Q BMVW-1	MT20	5.0	6.0	2.50
R BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
	FACTORED	MAXIMUM FACTORED	INPUT	REQD					
	GROSS REACTION	GROSS REACTION	BRG	BRG					
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
R	1884	0	1884	0	0	5-8	5-8		
J	1884	0	1884	0	0	5-8	5-8		
UNFACTORED REACTIONS									
JT	1ST CASE	MAX MIN.	COMPONENT	REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
R	1330	888 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0		
J	1330	888 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0		
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J									
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.82 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.									
LOADING									
TOTAL LOAD CASES: (4)									
CHORDS									
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)		
FR-TO					MEMB.				
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	Q-C	-301 / 0	0.07 (1)		
B-C	-2538 / 0	-91.8	-91.8 0.37 (1)	4.02	P-D	-294 / 0	0.18 (1)		
C-D	-2342 / 0	-91.8	-91.8 0.35 (1)	4.17	D-N	0 / 257	0.08 (1)		
D-E	-2493 / 0	-91.8	-91.8 0.54 (1)	3.82	N-F	0 / 575	0.13 (1)		
E-F	-2493 / 0	-91.8	-91.8 0.54 (1)	3.82	F-G	-885 / 0	0.40 (1)		
F-G	-2342 / 0	-91.8	-91.8 0.35 (1)	4.17	N-F	0 / 575	0.13 (1)		
G-H	-2538 / 0	-91.8	-91.8 0.37 (1)	4.02	L-F	0 / 257	0.08 (1)		
H-I	0 / 28	-91.8	-91.8 0.12 (1)	10.00	L-G	-284 / 0	0.18 (1)		
R-B	-1841 / 0	0.0	0.0 0.19 (1)	6.17	K-G	-301 / 0	0.07 (1)		
J-H	-1841 / 0	0.0	0.0 0.19 (1)	6.17	B-Q	0 / 2323	0.52 (1)		
					K-H	0 / 2323	0.52 (1)		
R-Q	0 / 0	-18.5	-18.5 0.10 (4)	10.00					
Q-P	0 / 2290	-18.5	-18.5 0.43 (1)	10.00					
P-O	0 / 2077	-18.5	-18.5 0.40 (1)	10.00					
O-N	0 / 2077	-18.5	-18.5 0.40 (1)	10.00					
N-M	0 / 2077	-18.5	-18.5 0.40 (1)	10.00					
M-L	0 / 2077	-18.5	-18.5 0.40 (1)	10.00					
L-K	0 / 2290	-18.5	-18.5 0.43 (1)	10.00					
K-J	0 / 0	-18.5	-18.5 0.10 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.06")
CALCULATED VERT. DEFL. (LL) = L/999 (0.13")
ALLOWABLE DEFL. (TL) = L/360 (1.06")
CALCULATED VERT. DEFL. (TL) = L/999 (0.24")

CSF: TC=0.54/1.00 (D-E:1), BC=0.43/1.00 (K-L:1), WB=0.52/1.00 (H-K:1), SSI=0.27/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1688

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 6.0 Deg.

ISI GRIP = 0.90 (B) (INPUT = 0.90)
ISI METAL = 0.67 (B) (INPUT = 1.00)

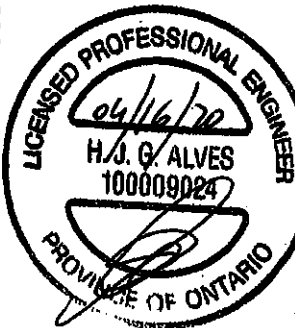


Structural component only
DWG# T-2006215

JOB NAME 408159	TRUSS NAME T34	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Pool Truss, Burlington

ID: MTW7E0QKRW7Mm2BLF7kizsx7-6RAIEETE13REJ1_Qsm5Yp7HHVBE4tr3_cuqY4zQU7P
Version 8.310 9 Oct 29 2019 Mittek Industries, Inc. Wed Apr 15 12:51:48 2020 Page 1
31-11-0 33-2-8
Scale = 1:50.6

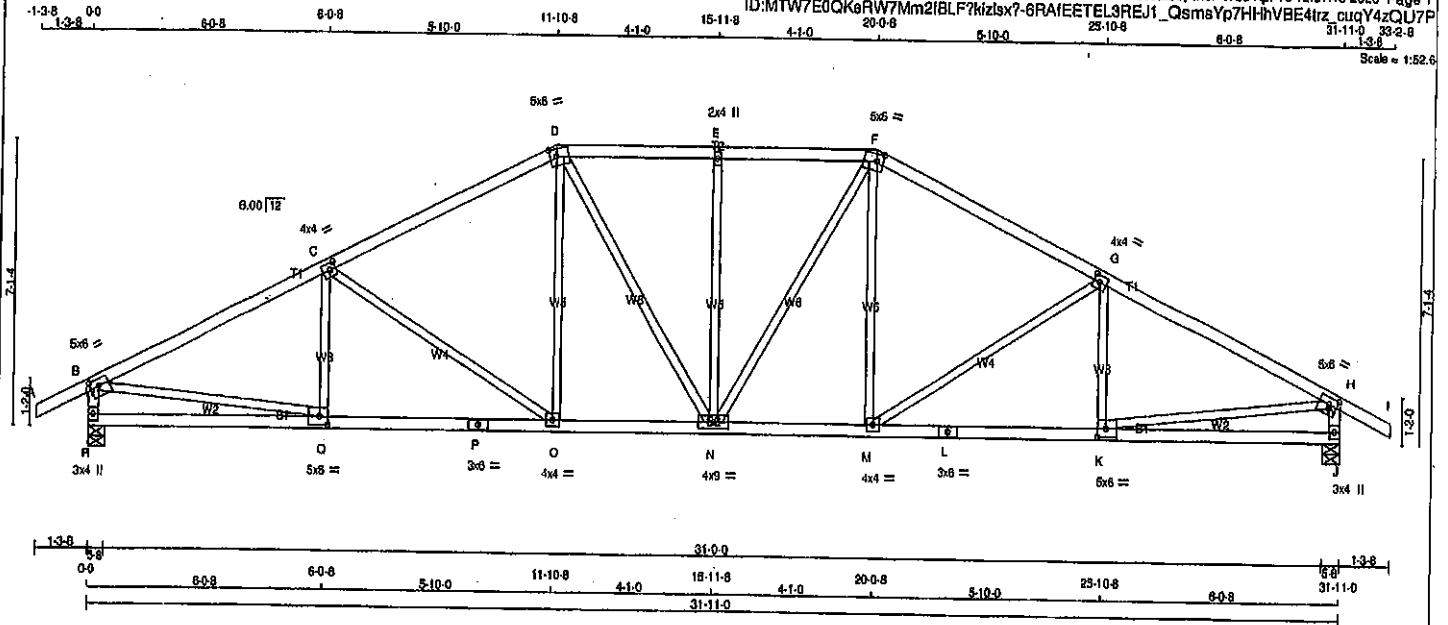

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
R - B	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
R - P	2x4	DRY	No.2	SPF	
P - L	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-I	MT20	5.0	6.0	2.00	2.75
C	TMVW-I	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	6.0	2.25	2.00
E	TMW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.25	2.00
G	TMVW-I	MT20	4.0	4.0	2.00	1.75
H	TMVW-I	MT20	5.0	6.0	2.00	2.75
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-I	MT20	5.0	6.0	2.50	2.50
L	BS-I	MT20	3.0	6.0		
M	BMVW-I	MT20	4.0	4.0		
N	BMVW-I	MT20	4.0	9.0		
O	BMVW-I	MT20	4.0	4.0		
P	BS-I	MT20	3.0	6.0		
Q	BMVW-I	MT20	5.0	6.0	2.50	2.50
R	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	HORIZ	UPLIFT	IN-SX	IN-SX	BRG	BRG
R	1884	0	1884	0	0	5-8	5-8		
J	1884	0	1884	0	0	5-8	5-8		

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERMLIVE	WIND	DEAD	SOIL
R	1330	888/0	0/0	0/0	0/0	444/0	0/0
J	1330	888/0	0/0	0/0	0/0	444/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/28	-91.8 -91.8 0.12 (1)	10.00	Q-C	-212/29	0.08 (1)	
B-C	-2579/0	-91.8 -91.8 0.55 (1)	3.79	C-O	-480/0	0.48 (1)	
C-D	-2188/0	-91.8 -91.8 0.49 (1)	4.11	O-D	0/382	0.08 (1)	
D-E	-2088/0	-91.8 -91.8 0.24 (1)	4.49	D-N	0/298	0.07 (1)	
E-F	-2088/0	-91.8 -91.8 0.24 (1)	4.49	N-E	-451/0	0.39 (1)	
F-G	-2188/0	-91.8 -91.8 0.49 (1)	4.11	N-F	0/298	0.07 (1)	
G-H	-2579/0	-91.8 -91.8 0.55 (1)	3.79	M-F	0/382	0.08 (1)	
H-I	0/28	-91.8 -91.8 0.12 (1)	10.00	M-G	-480/0	0.48 (1)	
R-B	-1838/0	0.0 0.0 0.19 (1)	6.18	K-G	-212/29	0.08 (1)	
J-H	-1838/0	0.0 0.0 0.19 (1)	6.18	B-Q	0/2355	0.53 (1)	
				K-H	0/2355	0.53 (1)	
R-Q	0/0	-18.5 -18.5 0.15 (4)	10.00				
Q-P	0/2332	-18.5 -18.5 0.44 (1)	10.00				
P-O	0/2332	-18.5 -18.5 0.44 (1)	10.00				
O-N	0/1935	-18.5 -18.5 0.37 (1)	10.00				
N-M	0/1935	-18.5 -18.5 0.37 (1)	10.00				
M-L	0/2332	-18.5 -18.5 0.44 (1)	10.00				
L-K	0/2332	-18.5 -18.5 0.44 (1)	10.00				
K-J	0/0	-18.5 -18.5 0.15 (4)	10.00				

TOTAL WEIGHT = 2 X 136 = 271 LBS (MIF)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2018

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.06")
CALCULATED VERT. DEFL. (LL) = L/999 (0.12")
ALLOWABLE DEFL. (TL) = L/360 (1.06")
CALCULATED VERT. DEFL. (TL) = L/999 (0.21")

CSI: TC=0.55/1.00 (G-H:1), BC=0.44/1.00 (K-M:1),
WB=0.53/1.00 (H-K:1), SS=0.24/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 769 1987 1650

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

SI GRIP=0.88 (H) (INPUT = 0.90)
SI METAL=0.74 (P) (INPUT = 1.00)

Structural component only
DWG# T-2008216

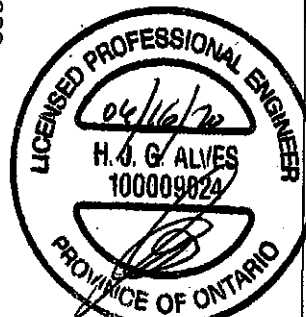

JOB NAME 408159	TRUSS NAME T35	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	
Version 8.310 9 Oct 2018 Mitek Industries, Inc. Wed Apr 15 12:51:46 2020 Page 1					
ID: MTW7E0QKerW7Mm2tBLF7kizlex7-azk1SaTt6NZ5x8ZcOUNnMLqOqvVmpK36CGdN4WzQU70					
31-11-0 33-2-8 1-3-8					
Scale = 1:53.3					

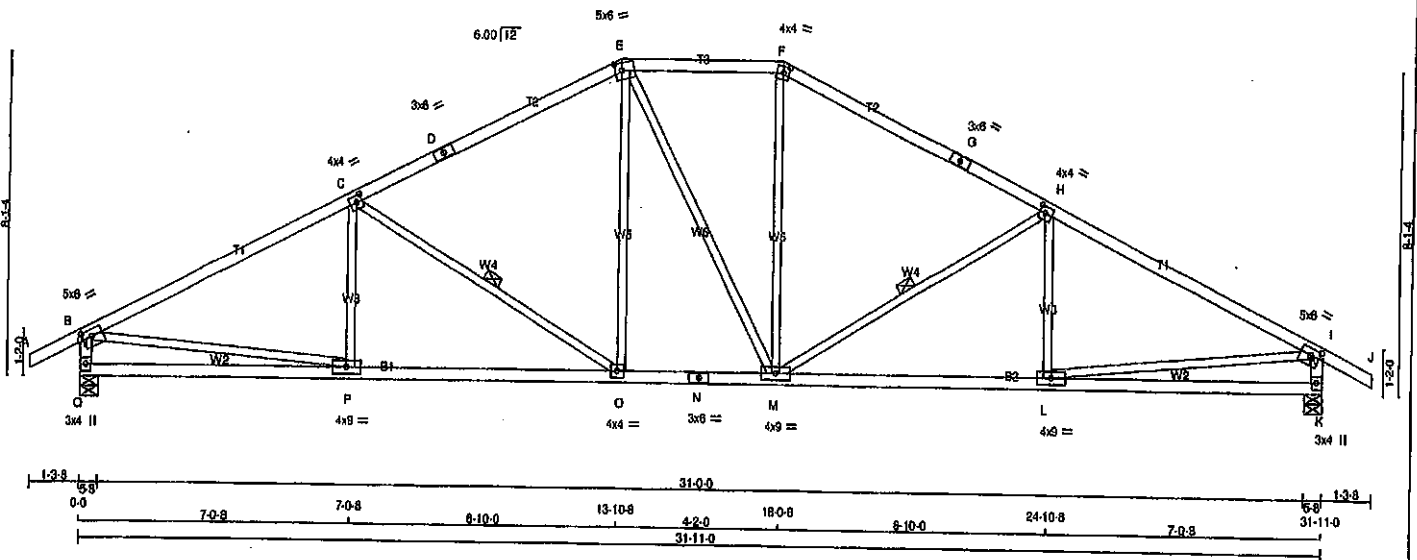

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
O - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-1	MT20	5.0	8.0	2.00 2.75
C	TMVW-1	MT20	4.0	4.0	2.00 1.75
D	TS-1	MT20	3.0	6.0	
E	TTWW-m	MT20	5.0	6.0	2.25 2.00
F	TTW-m	MT20	4.0	4.0	2.00 1.75
G	TS-1	MT20	3.0	6.0	
H	TMVW-1	MT20	4.0	4.0	2.00 1.75
I	TMVW-1	MT20	5.0	6.0	2.00 2.75
K	BMV1-p	MT20	3.0	4.0	
L	BMVW-1	MT20	4.0	9.0	
M	BMVWW-1	MT20	4.0	9.0	
N	BS-1	MT20	3.0	6.0	
O	BMVW-1	MT20	4.0	4.0	
P	BMVW-1	MT20	4.0	9.0	
Q	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
Q	1884	0	1884	0	0	5-8	5-8	5-8	5-8
K	1884	0	1884	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
Q	1330	888 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0
K	1330	888 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WELLS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	P-C	-140 / 71	0.05 (1)
B-C	-2587 / 0	-91.8	-91.8 0.78 (1)	3.47	C-O	-881 / 0	0.31 (1)
C-D	-2013 / 0	-91.8	-91.8 0.68 (1)	3.97	O-E	0 / 458	0.10 (1)
D-E	-2013 / 0	-91.8	-91.8 0.68 (1)	3.97	E-M	0 / 2	0.00 (1)
E-F	-1775 / 0	-91.8	-91.8 0.24 (1)	4.79	M-F	0 / 480	0.10 (1)
F-G	-2013 / 0	-91.8	-91.8 0.68 (1)	3.97	M-H	-680 / 0	0.31 (1)
G-H	-2013 / 0	-91.8	-91.8 0.68 (1)	3.97	H-I	-142 / 70	0.05 (1)
H-I	-2587 / 0	-91.8	-91.8 0.78 (1)	3.47	I-J	0 / 2382	0.53 (1)
I-J	0 / 28	-91.8	-91.8 0.12 (1)	10.00	J-K	0 / 2381	0.53 (1)
K-L	-1830 / 0	0.0	0.0 0.18 (1)	8.19			
L-K	-1830 / 0	0.0	0.0 0.18 (1)	8.19			
Q-P	0 / 0	-18.5	-18.5 0.22 (4)	10.00			
P-O	0 / 2344	-18.5	-18.5 0.48 (1)	10.00			
O-N	0 / 1774	-18.5	-18.5 0.35 (1)	10.00			
N-M	0 / 1774	-18.5	-18.5 0.35 (1)	10.00			
M-L	0 / 2344	-18.5	-18.5 0.48 (1)	10.00			
L-K	0 / 0	-18.5	-18.5 0.22 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.08")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.78/1.00 (B-C:1), BC=0.45/1.00 (O-P:1),
WB=0.53/1.00 (B-P:1), SSI=0.28/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BENO=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 810 354 1857 785 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (B) (INPUT = 0.88)
JSI METAL= 0.70 (B) (INPUT = 1.00)

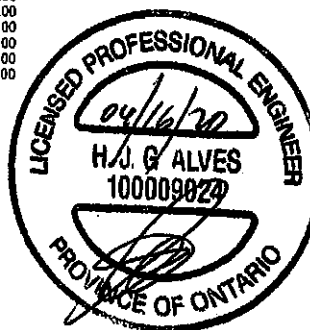


Structural component only
DWG# T-2006217

Structural component only
DWG# T-2006218

JOB NAME 408159	TRUSS NAME T38	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamareck Roof Truss, Burlington

Version 8.310 5 Oct 2019 MITek Industries, Inc. Wed Apr 15 12:51:52 2020 Page 1
ID:MTW7E0QKRW7Mm2IBLF7Kizlsx?_CPA4GWIQiyoslB5cxU_zS7w7bn0nuYuEs1hrzQU7L

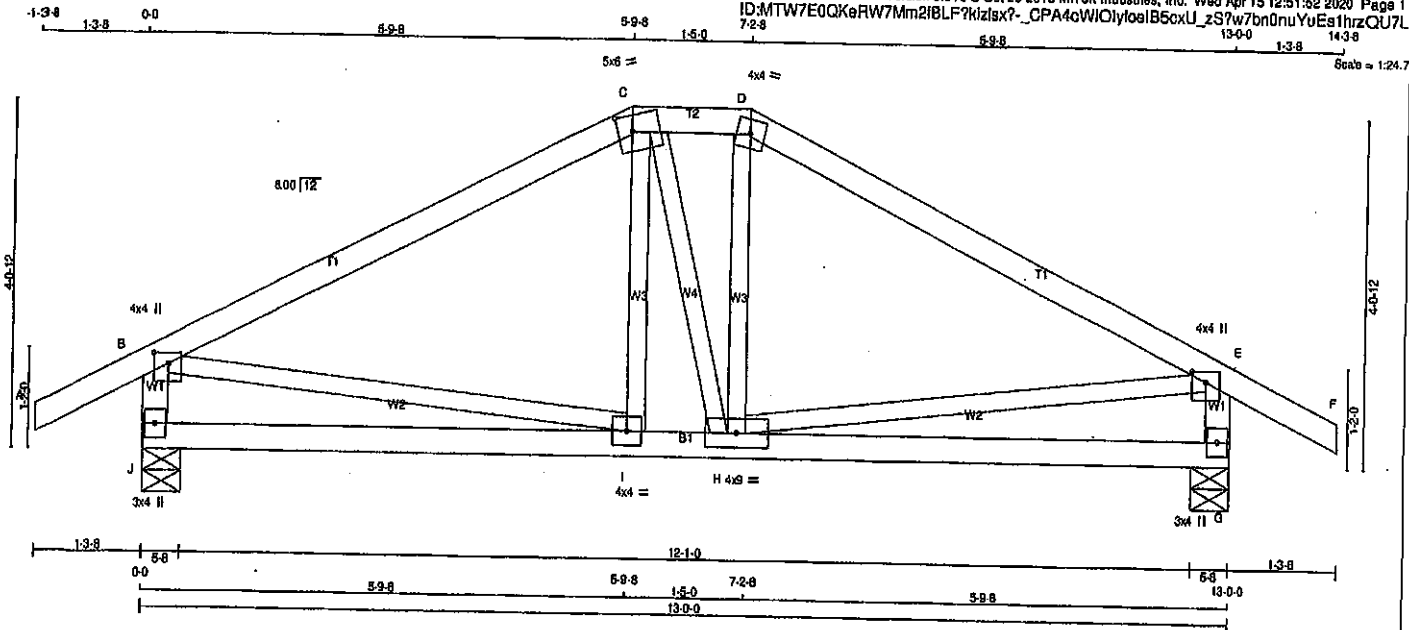

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
A - O	2x4 DRY	No.2	SPF
C - D	2x4 DRY	No.2	SPF
D - F	2x4 DRY	No.2	SPF
J - B	2x4 DRY	No.2	SPF
G - E	2x4 DRY	No.2	SPF
J - G	2x4 DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMVV+p	MT20	4.0	4.0	1.50 2.00
C	TTWW-m	MT20	5.0	6.0	2.25 2.00
D	TTW-m	MT20	4.0	4.0	
E	TMVV+p	MT20	4.0	4.0	1.50 2.00
G	BMV1+p	MT20	3.0	4.0	
H	BMVWW-t	MT20	4.0	9.0	
I	BMVWW-t	MT20	4.0	4.0	
J	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
J	841	0	841	0	5-8
G	841	0	841	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	593	402 / 0	0 / 0	0 / 0	0 / 0	180 / 0	0 / 0
G	593	402 / 0	0 / 0	0 / 0	0 / 0	180 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-91.8 -91.8	0.12 (1)	10.00	I-C	-19 / 47	0.02 (4)
B-C	-702 / 0	-91.8 -91.8	0.40 (1)	8.25	C-H	0 / 6	0.00 (4)
C-D	-628 / 0	-91.8 -91.8	0.03 (1)	8.25	H-D	-16 / 62	0.02 (4)
D-E	-703 / 0	-91.8 -91.8	0.40 (1)	8.25	B-I	0 / 634	0.14 (1)
E-F	0 / 28	-91.8 -91.8	0.12 (1)	10.00	H-E	0 / 635	0.14 (1)
J-B	-798 / 0	0.0 0.0	0.08 (1)	7.81			
G-E	-795 / 0	0.0 0.0	0.08 (1)	7.81			
J-I	0 / 0	-18.5 -18.5	0.14 (4)	10.00			
I-H	0 / 627	-18.5 -18.5	0.21 (4)	10.00			
H-G	0 / 0	-18.5 -18.5	0.15 (4)	10.00			

TOTAL WEIGHT = 54 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6 PSF
	DL	= 6.0 PSF
BOT CH.	LL	= 0.0 PSF
	DL	= 7.4 PSF
TOTAL LOAD		= 39.0 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.43")
CALCULATED VERT. DEFL. (LL) = $U/999$ (0.01")
ALLOWABLE DEFL. (TL) = $L/360$ (0.43")
CALCULATED VERT. DEFL. (TL) = $U/999$ (0.05")

CSI: TC=0.40/1.00 (D-E:1), BC=0.21/1.00 (H-I:4), WB=0.14/1.00 (E-H:1), SS=0.19/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PS) (PL) (PLJ)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1987 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 6.0 Deg.


JSI GRIP= 0.81 (E) (INPUT = 0.90)
JSI METAL= 0.23 (I) (INPUT = 1.00)



Structural component only
DWG# T-2006220

JOB NAME 408159	TRUSS NAME T39	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 5 Oct 2019 MTEK Industries, Inc. Thu Apr 18 08:17:12 2020 Page 1
ID:MTW7E0QKerW7Mm2fBLF7klzlsx7-lfFpgh88D7qArXF53L_ohKuiAgOOaA_P7uIBzQD2r

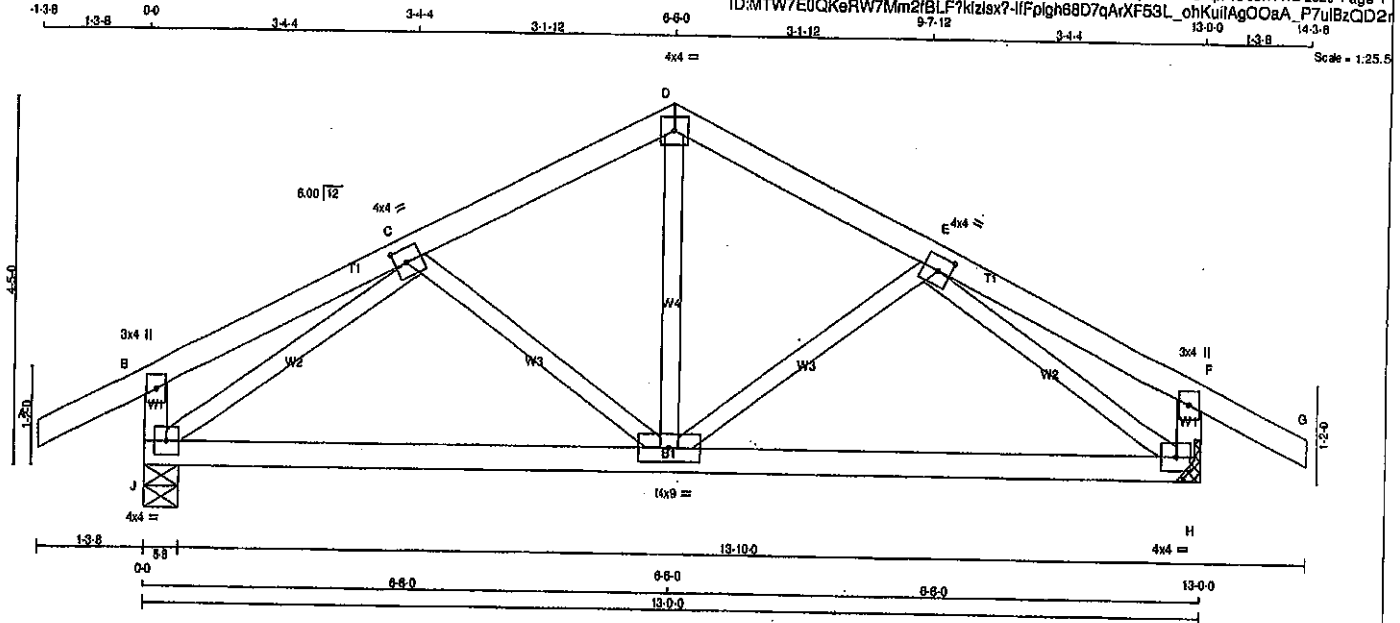

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESC
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
J - B	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT		2x3	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-I	MT20	4.0	4.0	2.00	1.75
D	TTW-p	MT20	4.0	4.0		
E	TMVW-I	MT20	4.0	4.0	2.00	1.75
F	TMV+p	MT20	3.0	4.0		
H	BMVW-I	MT20	4.0	4.0		
I	BMVW-I	MT20	4.0	9.0		
J	BMVW-I	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG	IN-SX
JT VERT	DOWN	HORZ	UPLIFT	IN-SX
J	841	0	841	5-8
H	841	0	841	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3'-8".

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	593	402 / 0	0 / 0	0 / 0	0 / 0	180 / 0	0 / 0
H	593	402 / 0	0 / 0	0 / 0	0 / 0	190 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNSPACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LG1 MAX CSI (LC)	MAX. UNBRAC LENGTH FR-TO	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	I-D	0 / 355	0.03 (1)	
B-C	0 / 14	-91.8	-91.8	0.14 (1)	10.00	I-E	-171 / 0	0.05 (1)	
C-D	-872 / 0	-91.8	-91.8	0.11 (1)	8.25	C-I	-171 / 0	0.05 (1)	
D-E	-872 / 0	-91.8	-91.8	0.11 (1)	8.25	J-C	-910 / 0	0.28 (1)	
E-F	0 / 14	-91.8	-91.8	0.14 (1)	10.00	E-H	-910 / 0	0.25 (1)	
F-G	0 / 28	-91.8	-91.8	0.12 (1)	10.00				
J-B	-242 / 0	0.0	0.0	0.02 (1)	7.81				
H-F	-242 / 0	0.0	0.0	0.02 (1)	7.81				
J-I	0 / 724	-18.5	-18.5	0.28 (4)	10.00				
I-H	0 / 724	-18.5	-18.5	0.28 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.43")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.02")
ALLOWABLE DEFL.(TL) = $L/360$ (0.43")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.05")

CSI: TC=0.14/1.00 (E-F:1), BC=0.28/1.00 (I-J:4),
WB=0.25/1.00 (G-J:1), SB=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1688

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.81 (H) (INPUT = 0.80)
JSI METAL= 0.31 (C) (INPUT = 1.00)

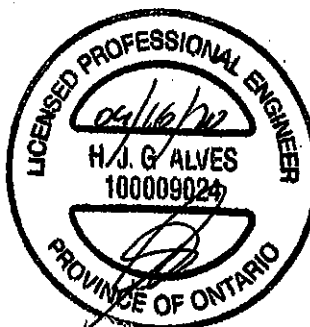

Structural component only
DWG# T-2006221

JOB NAME 408159	TRUSS NAME T41	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 16 12:51:54 2020 Page 1
ID:MTW7E0QKRW7Mm2BLF7kzdx7-xaXwVHX?wvCN1ySD1zy3OXKnwCsUjcrMYL8kzQU7J

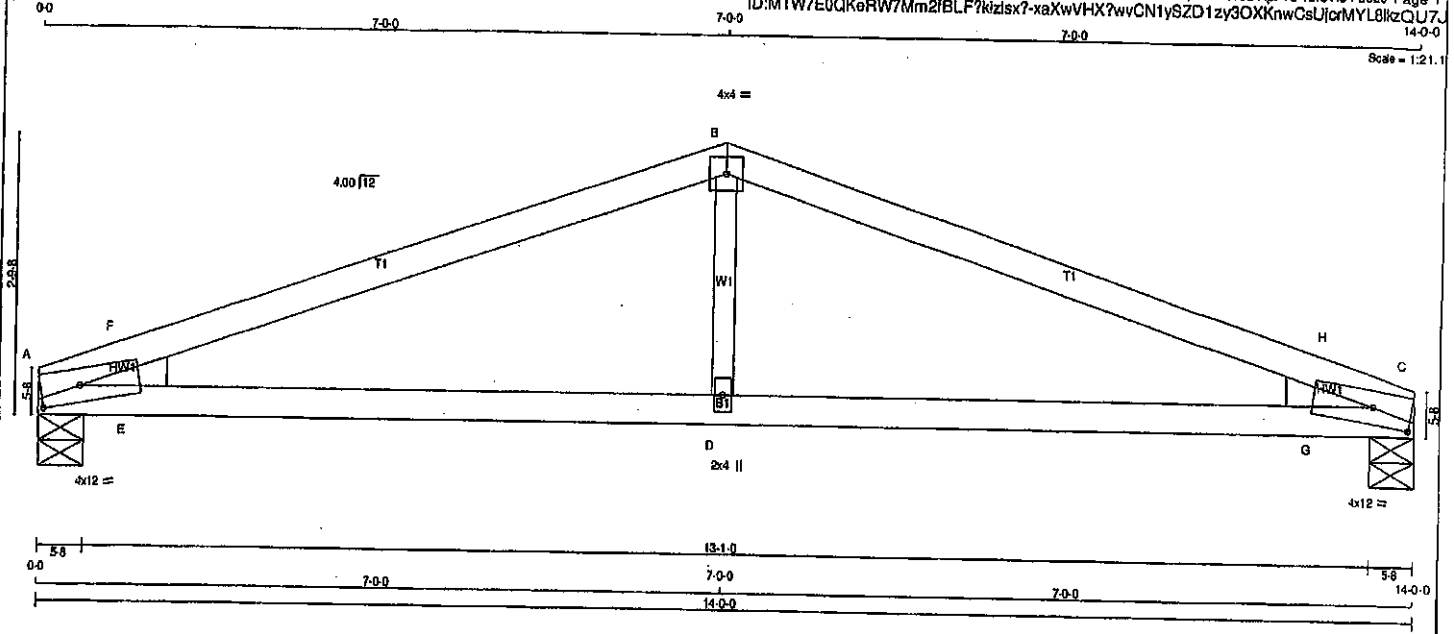

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	SPF
B - C	2x4	DRY	SPF
A - C	2x4	DRY	SPF

ALL WEBS 2x3 DRY
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMBH1-m	MT20	4.0	12.0	2.00	4.75
B	TTW-p	MT20	4.0	4.0		
C	TMBH1-m	MT20	4.0	12.0	2.00	4.75
D	BMW-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG	HEEL WEDGE
	VERT	HORZ	DOWN	HORZ			
A	772	0	772	0	5-8	5-8	2x4 L
C	772	0	772	0	5-8	5-8	2x4 R

UNFACTORED REACTIONS

JT	1ST LOASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
A	546	358 / 0	0 / 0	0 / 0	0 / 0	188 / 0	0 / 0
C	546	358 / 0	0 / 0	0 / 0	0 / 0	188 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.07 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO		FR-TO			
A-F	-1258 / 0	-91.8	-91.8 0.16 (1)	5.57	D-B	0 / 280	0.08 (1)
F-B	-1253 / 0	-91.8	-91.8 0.51 (1)	5.07	E-F	-292 / 8	0.00 (1)
B-H	-1253 / 0	-91.8	-91.8 0.51 (1)	5.07	G-H	-292 / 8	0.00 (1)
H-C	-1258 / 0	-91.8	-91.8 0.16 (1)	5.57			
A-E	0 / 1181	-18.5	-18.5 0.55 (1)	10.00			
E-D	0 / 1181	-18.5	-18.5 0.55 (1)	10.00			
D-G	0 / 1181	-18.5	-18.5 0.55 (1)	10.00			
G-C	0 / 1181	-18.5	-18.5 0.55 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.47")
CALCULATED VERT. DEFL. (LL) = L/999 (0.09")
ALLOWABLE DEFL. (TL) = L/360 (0.47")
CALCULATED VERT. DEFL. (TL) = L/999 (0.16")

CSI: TC=0.51/1.00 (B-F:1), BC=0.55/1.00 (A-E:1), WB=0.08/1.00 (B-D:1), SS=0.22/1.00 (B-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	818	354

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.48 (B) (INPUT = 0.90)
JSI METAL= 0.17 (B) (INPUT = 1.00)

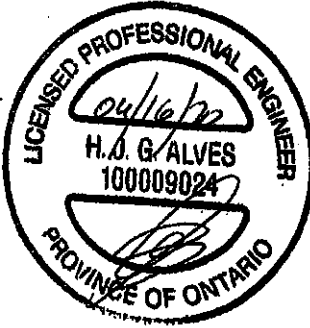

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408157	PB1	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 28 2019 Mitek Industries, Inc. Wed Apr 15 12:13:21 2020 Page 1
ID:7R4Dg_C9IAuIONuKplv7nzzlwO4-9bGW2OY8eEnZ2V71DmzYpdE5UYu41cqOUBYE4lzQUhS

Scale = 1:22.7

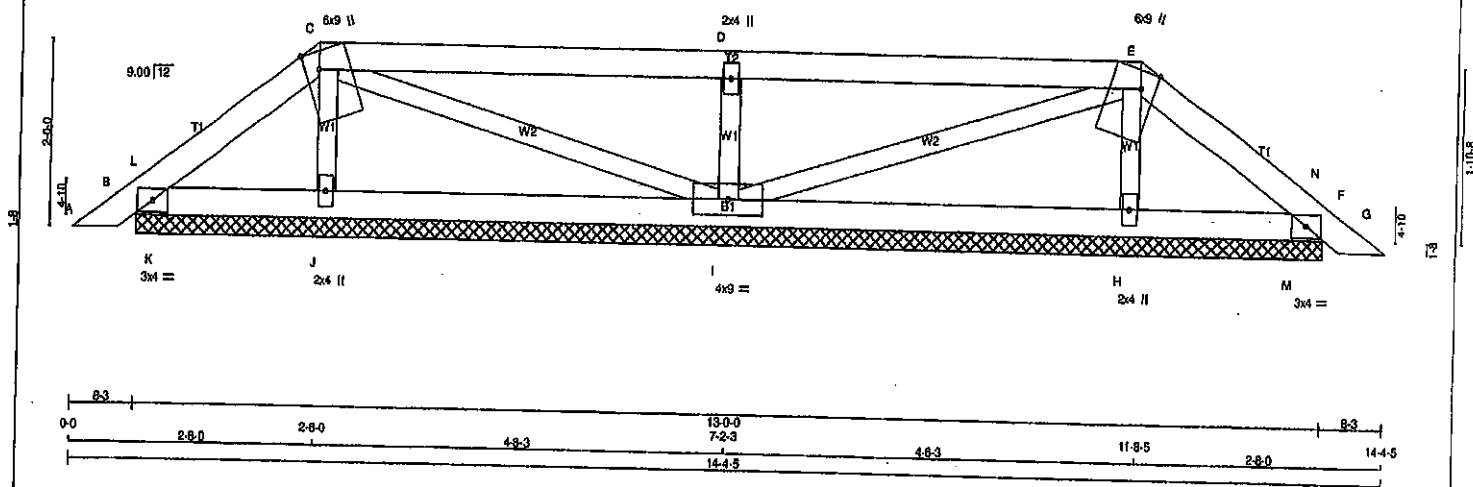

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - K	2x4	DRY	No.2
K - M	2x4	DRY	No.2
M - O	2x4	DRY	No.2
O - Q	2x4	DRY	No.2
Q - S	2x4	DRY	No.2
S - U	2x4	DRY	No.2
U - W	2x4	DRY	No.2
W - Y	2x4	DRY	No.2
Y - Z	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	3.0	4.0
C	TTWW+m	MT20	6.0	9.0
D	TWW+m	MT20	2.0	4.0
E	TTWW+m	MT20	6.0	9.0
F	TMB1-I	MT20	3.0	4.0
H	BMW1+w	MT20	2.0	4.0
I	BMWW1-I	MT20	4.0	8.0
J	BMW1+w	MT20	2.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX		REQD BRG IN-SX	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	BRG	BRG
B	188	0	188	0	0	13-0-0	13-0-0
F	188	0	188	0	0	13-0-0	13-0-0
J	278	0	278	0	0	13-0-0	13-0-0
I	616	0	616	0	0	13-0-0	13-0-0
H	278	0	278	0	0	13-0-0	13-0-0

UNFACTORED REACTIONS

1ST CASE		MAX/MIN COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM	LIVE	WIND	DEAD	SOIL	SOIL
B	129	99/0	0/0	0/0	0/0	30/0	0/0	0/0	0/0
F	129	99/0	0/0	0/0	0/0	30/0	0/0	0/0	0/0
J	189	117/0	0/0	0/0	0/0	82/0	0/0	0/0	0/0
I	433	295/0	0/0	0/0	0/0	139/0	0/0	0/0	0/0
H	189	117/0	0/0	0/0	0/0	82/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F, J, I, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. FORCE (LBS)	MAX. CSI (LC)
FR-TO	0/15	FROM TO	LENGTH FR-TO	J-C	-188/0	0.03 (1)	
A-B	0/15	-91.8	-91.8 0.02 (1)	C-I	-24/0	0.01 (1)	
B-L	-35/0	-91.8	-91.8 0.01 (1)	I-D	-517/0	0.08 (1)	
L-C	-57/0	-91.8	-91.8 0.04 (1)	E-H	-24/0	0.01 (1)	
C-D	-7/0	-91.8	-91.8 0.32 (1)	H-E	-189/0	0.03 (1)	
D-E	-7/0	-91.8	-91.8 0.32 (1)	K-L	-123/0	0.00 (1)	
E-N	-57/0	-91.8	-91.8 0.04 (1)	M-N	-123/0	0.00 (1)	
N-F	-35/0	-91.8	-91.8 0.01 (1)				
F-G	0/15	-91.8	-91.8 0.02 (1)				
B-K	0/43	-18.5	-18.5 0.05 (1)				
K-J	0/43	-18.5	-18.5 0.08 (4)				
J-I	0/30	-18.5	-18.5 0.08 (4)				
I-H	0/30	-18.5	-18.5 0.08 (4)				
H-M	0/43	-18.5	-18.5 0.08 (4)				
M-F	0/43	-18.5	-18.5 0.05 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.32/1.00 (C-D:1), BC=0.08/1.00 (H-I:4),
WB=0.08/1.00 (D-I:1), SS=0.20/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1997 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.27 (D) (INPUT = 0.80)
JSI METAL = 0.11 (D) (INPUT = 1.00)

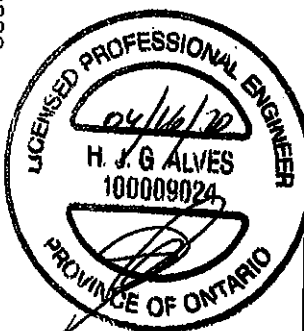

Structural component only
DWG# T-2006179

JOB NAME 408157	TRUSS NAME PB2	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitel Industries, Inc. Wed Apr 15 12:13:22 2020 Page 1
ID:7R4Dg_C9IAuIONuKplv7nzzlwQ4-doaGkZmPYvQgeIDnTVnMmBGxDbm4YrHnckzQUhR
Scale = 1:22.7

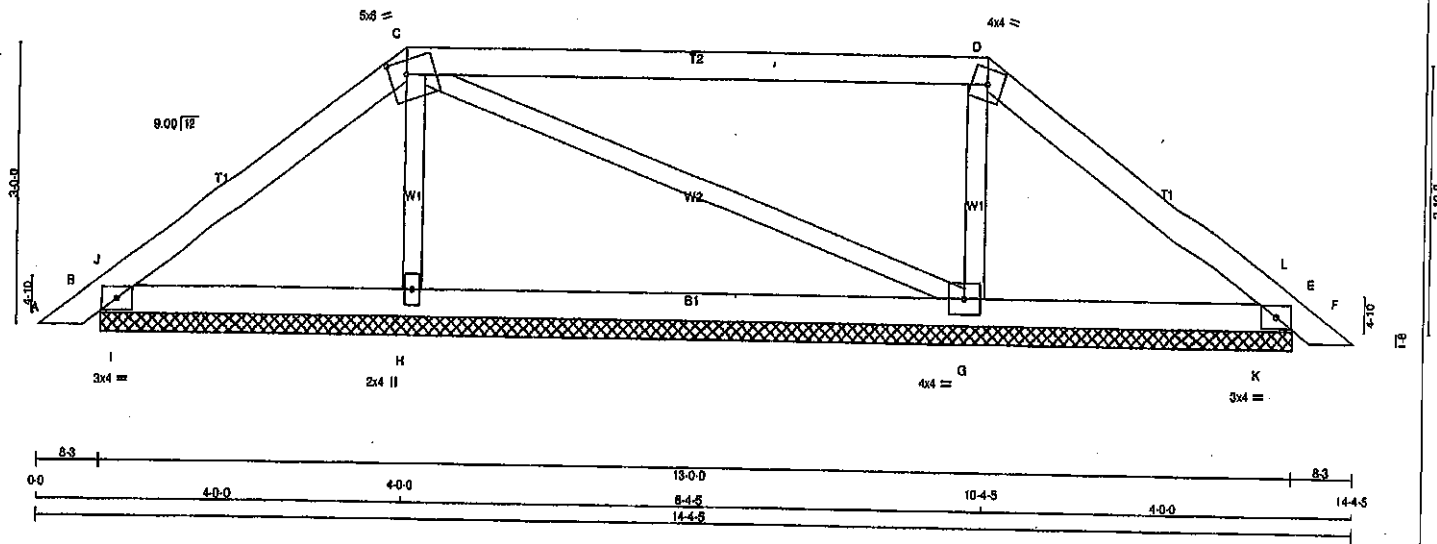

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
B - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY, SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TM81-I	MT20	3.0	4.0	
C	TTWW-m	MT20	5.0	8.0	1.75 2.25
D	TTWW-m	MT20	4.0	4.0	
E	TM81-I	MT20	3.0	4.0	
G	BMWW-I	MT20	4.0	4.0	
H	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	SNOW	GROSS REACTION	DOWN	BRG	IN-SX	IN-SX	BRG
B	308	0	308	0	0	13-0-0	13-0-0	13-0-0	13-0-0
E	288	0	288	0	0	13-0-0	13-0-0	13-0-0	13-0-0
H	456	0	456	0	0	13-0-0	13-0-0	13-0-0	13-0-0
G	493	0	493	0	0	13-0-0	13-0-0	13-0-0	13-0-0

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
B	212	181/0	0/0	0/0	0/0	52/0	0/0
E	200	151/0	0/0	0/0	0/0	49/0	0/0
H	325	197/0	0/0	0/0	0/0	128/0	0/0
G	351	217/0	0/0	0/0	0/0	133/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	MAX. CSI (LC)
A-B	0/15	-91.8	-91.8 0.02 (1)	H-C	-327/0	0.06 (1)	
B-J	-48/0	-91.8	-91.8 0.06 (1)	C-G	-28/0	0.02 (1)	
J-C	-145/0	-91.8	-91.8 0.12 (1)	G-D	-354/0	0.06 (1)	
C-D	-72/0	-91.8	-91.8 0.63 (1)	I-J	-292/0	0.00 (1)	
D-L	-118/0	-91.8	-91.8 0.12 (1)	K-L	-295/0	0.00 (1)	
L-E	-17/0	-91.8	-91.8 0.05 (1)				
E-F	0/15	-91.8	-91.8 0.02 (1)				
B-I	0/109	-18.5	-18.5 0.12 (1)				
I-H	0/109	-18.5	-18.5 0.13 (4)				
H-G	0/96	-18.5	-18.5 0.13 (4)				
G-K	0/88	-18.5	-18.5 0.12 (4)				
K-E	0/88	-18.5	-18.5 0.12 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.03/1.00 (C-D:1), BC=0.13/1.00 (H-I:4), WB=0.08/1.00 (D-G:1), SS=0.23/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1887 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.26 (B) (INPUT = 0.90)
JSI METAL= 0.07 (H) (INPUT = 1.00)



Structural component only
DWG# T-2006180

JOB NAME 408159	TRUSS NAME J1	QUANTITY 18	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

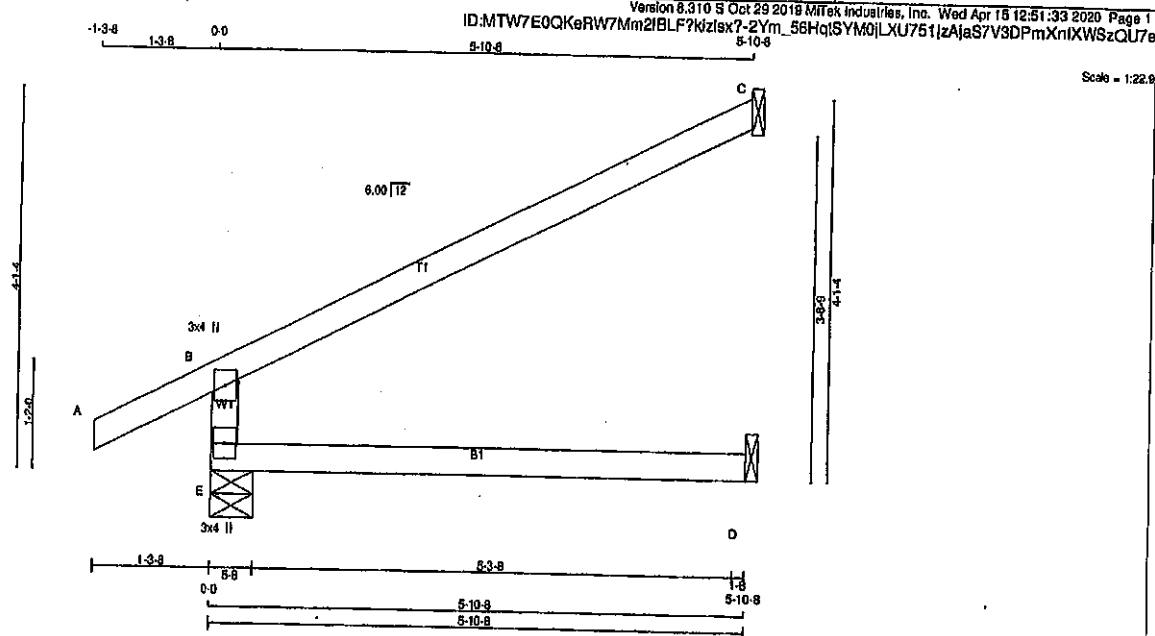

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED		MAXIMUM FACTORED		INPUT		REQD	
	GROSS REACTION		GROSS REACTION		BRG		BRG	
E	525	0	525	0	5-8		5-8	
C	202	0	202	0	1-8		1-8	
D	45	0	50	0	1-8		1-8	

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	389	257/0	0/0	0/0	0/0	111/0	0/0
C	139	113/0	0/0	0/0	0/0	28/0	0/0
D	36	0/0	0/0	0/0	0/0	36/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LG1 MAX	MEMB.	FORCE (LBS)	MAX. FACTORED	CS1 (LC)
FR-TO		FROM TO		FR-TO			
E-B	-461/0	0.0	0.0 0.13 (4)	7.81			
A-B	0/28	-91.8	-91.8 0.12 (1)	10.00			
B-C	-30/0	-91.8	-91.8 0.54 (1)	6.25			
E-D	0/0	-18.5	-18.5 0.13 (4)	10.00			

TOTAL WEIGHT = 18 X 17 = 302 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 8.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/899 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/899 (0.03")

CS1: TC=0.54/1.00 (B-C:1), RC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS1=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	816 354 1667 788 1987 1658	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (E) (INPUT = 0.80)
JSI METAL = 0.13 (B) (INPUT = 1.00)

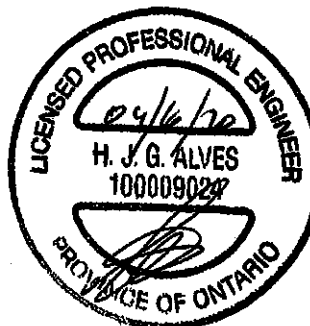

Structural component only
DWG# T-2006203

JOB NAME 408157	TRUSS NAME J1	QUANTITY 25	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 28 2019 Mitek Industries, Inc. Wed Apr 16 12:13:15 2020 Page 1
 ID:7R4Dg_C9IAulONuKplv?nzzlwO4-KSvFoLTN2O1QkagHtVt8aM_?W7ptdvWW6F5wsezQUhY
 Scale = 1/22.5

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
E - B	2x4	No.2	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

DESOR.

SPF

SPF

SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQ'D BRG IN-SX
	VERT	HORIZ	GROSS	REACT		
E	525	0	525	0	5-8	5-8
C	202	0	202	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL E97791H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED		MAX./MIN. COMPONENT REACTIONS					
	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
E	389	257 / 0	0 / 0	0 / 0	0 / 0	111 / 0		
C	139	113 / 0	0 / 0	0 / 0	0 / 0	28 / 0		
D	36	0 / 0	0 / 0	0 / 0	0 / 0	38 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		MAX. CSI (LC)	UNBRACED LENGTH	FR-TO	MEMB.	WEBS		MAX. CSI (LC)
	MAX. FORCE (LBS)	VERT. LOAD (PLF)	VERT. LOAD (LBS)	FACTORED (LBS)					MAX. FORCE (LBS)		
E-B	-481 / 0	0.0	0.0	0.0	0.13 (4)	7.81	FR-TO				
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00						
B-C	-30 / 0	-91.8	-91.8	0.54 (1)	6.25						
E-D	0 / 0	-18.5	-18.5	0.13 (4)	10.00						

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN.GG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA C88-09, CSA C88-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")

CALCULATED VERT. DEFL.(LL) = L/899 (0.00")

ALLOWABLE DEFL.(TL)= L/360 (0.20")

CALCULATED VERT. DEFL.(TL) = L/899 (0.03")

CSI TC=0.84/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (N/A:0), SSL=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PS)	SECTION (PLI)
MT20	818	354
MT20	1687	789
MT20	1687	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.19 (E) (INPUT = 0.90)

JSI METAL= 0.13 (B) (INPUT = 1.00)

Structural component only

DWG# T-2006173

04/16/20

H. J. G. ALVES


100009024

PROVINCE OF ONTARIO

JOB NAME 408157	TRUSS NAME J2	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2018 MITek Industries, Inc. Wed Apr 15 12:13:16 2020 Page 1
ID:7R4Dg_C9iAuIONuKplv?nzzhwO4-osTd?hU?pi9HxjF3QDON6aXGXAPMMiIKvqTO5zQUhX

Scale = 1:18.8

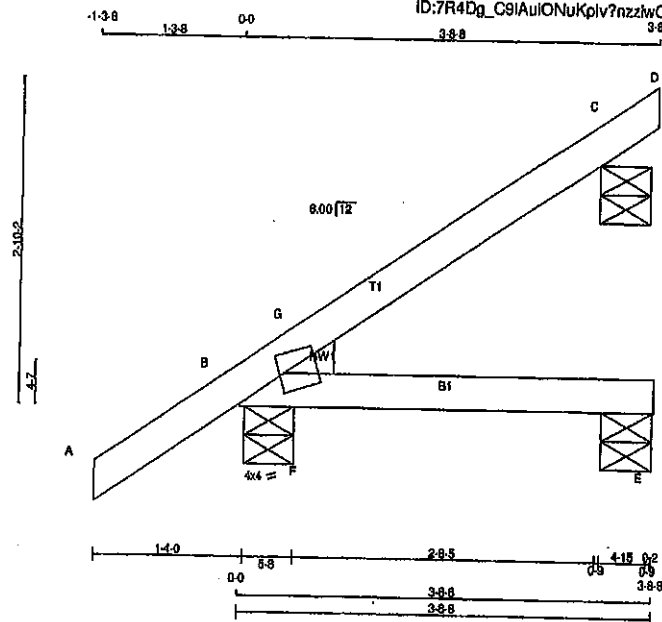

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.	SPF
A - D	2x4	DRY	No.2			
B - E	2x4	DRY	No.2			

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATE	W	LEN	Y	X
B	TMBH1-m	MT20	4.0	4.0	2.00 0.80

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	REORD BRG IN-SX	HEEL WEDGE
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
B	319	0	319	0	0
E	55	0	55	0	0
C	168	0	168	0	0

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX MIN. SNOW	MIN. LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	223	159 / 0	0 / 0	0 / 0	0 / 0	64 / 0	0 / 0
E	41	15 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0
C	118	80 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS			FACTORED				WEBS			
MEMB.	MAX. FORCE (LBS)		VERT. LOAD (PLF)	LC1	MAX. CSI (LC)		MEMB.	MAX. FORCE (LBS)	FACTORED MAX CSI (LC)	
FR-TO			FROM	TO			FR-TO			
A-B	0 / 34		-91.8	-91.8	0.14 (5)	10.00				
B-G	-18 / 0		-91.8	-91.8	0.04 (4)	8.25	F-G	-121 / 9	0.00 (1)	
G-O	0 / 4		-91.8	-91.8	0.13 (1)	10.00				
C-D	-9 / 0		-91.8	-91.8	0.01 (1)	10.00				
B-F	0 / 0		-18.5	-18.5	0.11 (1)	10.00				
F-E	0 / 0		-18.5	-18.5	0.11 (1)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:	TOP CH.	LL	PSF
	DL	25.8	PSF
	DL	8.0	PSF
	DL	0.0	PSF
	DL	7.4	PSF
	TOTAL LOAD	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/899$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/899$ (0.02")

CSI: TC=0.14/1.00 (A-B:5), BC=0.11/1.00 (E-F:1), WB=0.00/1.00 (F-G:1), SS=0.11/1.00 (B-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRIP(ORV)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788	1897 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.60)
JSI METAL = 0.05 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006174

JOB NAME 408157	TRUSS NAME J3	QUANTITY 7	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Trues, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Wed Apr 15 12:13:17 2020 Page 1
ID:7R4Dg_G8IAuIONuKply?nzzlwO4-Gq1?D1Vda0H8ZtqG_wvcfn4RQwWA5p?pZZa1wXzQUhw

Scale = 1:15.2

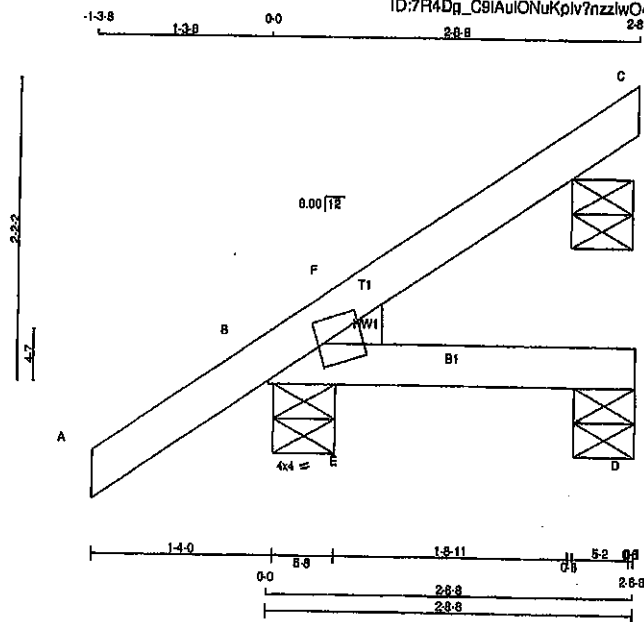

LUMBER					
N. L. G. A. RULES					
CHORDS SIZE	LUMBER	DESCR.			
A - C 2x4 DRY	No.2	SPF			
B - D 2x4 DRY	No.2	SPF			
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMBH1-m	MT20	4.0	4.0	2.00 0.50

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	REGRD BRG IN-SX	HEEL WEDGE
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
C	103	0	103	0	0
B	275	0	275	0	0
D	47	0	47	0	0

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

	1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
C	71	55 / 0	0 / 0	0 / 0	0 / 0	16 / 0	0 / 0
B	182	140 / 0	0 / 0	0 / 0	0 / 0	63 / 0	0 / 0
D	34	14 / 0	0 / 0	0 / 0	0 / 0	20 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B, D

BRACING
TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

	CHORDS							WEBS			
	MAX. FACTORED	FACTORED						MAX. FACTORED			
MEMB.	FORCE	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED	FORCE	MAX		
	(LBS)	(PLF)	CSI (LC)	UNBRAC	LENGTH		(LBS)	CSI (LC)			
FR-TO		FROM TO				FR-TO					
A-B	0 / 34	-91.8	-91.8	0.13 (5)	10.00	E-F	-93 / 0	0.00 (1)			
B-F	-15 / 0	-91.8	-91.8	0.02 (4)	6.25						
F-C	0 / 4	-91.8	-91.8	0.08 (1)	10.00						
B-E	0 / 0	-18.5	-18.5	0.08 (1)	10.00						
E-D	0 / 0	-18.5	-18.5	0.08 (1)	10.00						

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19')
CALCULATED VERT. DEFL.(LL) = L/999 (0.00')
ALLOWABLE DEFL.(TL) = L/360 (0.19')
CALCULATED VERT. DEFL.(TL) = L/999 (0.01')

CSI: TC=0.13/1.00 (A-B-5), BC=0.08/1.00 (D-E-1), WB=0.00/1.00 (E-F-1), SSI=0.09/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE GRIP(DRY)	SHEAR	SECTION			
(PSI)	(PLI)	(PLI)			
MAX MIN	MAX MIN	MAX MIN			
MT20	618 354 1887 788 1887 1656				

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.90)
JSI METAL= 0.04 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006175

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408157	J5	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

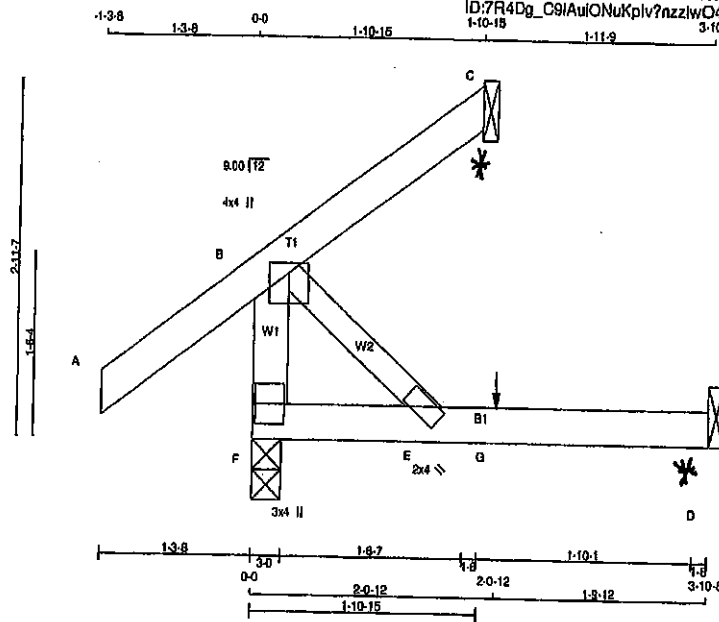

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
E	BMVW+p	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	REQD BRG IN-SX
JT	VERT	HORZ	DOWN	HORZ
F	298	0	298	0
C	42	0	42	0
D	38	0	40	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 160 LBS FACTORED UPLIFT

	1ST LOASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE			
F	208	145/0	0/0	0/0	83/0	0/0
C	29	23/-25	0/0	0/0	5/0	0/0
D	29	0/0	0/0	0/0	29/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

	CHORDS	FACTORED	W E B S	FACTORED
	MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)
	FR-TO	FROM TO	FR-TO	FROM TO
F-B	-260/0	0.0	0.0	0.03 (1)
A-B	0/38	-91.8	-91.8	0.14 (5)
B-C	-27/0	-91.8	-91.8	0.13 (5)
F-E	0/0	-18.5	-18.5	0.08 (4)
E-G	0/0	-18.5	-18.5	0.08 (4)
G-D	0/0	-18.5	-18.5	0.08 (4)

	FACTORED CONCENTRATED LOADS (LBS)	FACE	DIR.	TYPE	HEEL	CONN.
JT	LOC.	LC1	MAX-	MAX+	BACK	VERT
G	2.0-12	1	1	---	---	---

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 12 = 36 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/898 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/898 (0.01")

CSI: TC=0.14/1.00 (A-B:5), BC=0.08/1.00 (D-E:4),
WB=0.00/1.00 (B-E:1), SSI=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 L.S BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1897 788 1897 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.21 (B) (INPUT = 0.80)
JSI METAL= 0.05 (B) (INPUT = 1.00)

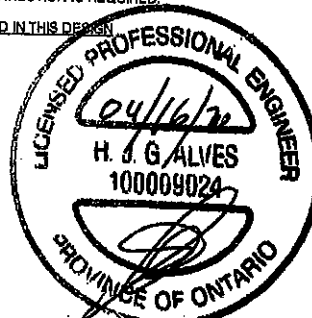


Structural component only
DWG# T-2006177

JOB NAME 408157	TRUSS NAME J6	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 12:13:20 2020 Page 1
ID:7R4Dg_C9lAuONuKplv?nzzlwO4-hPI8I2XWxtQLYqf2SJHQx08YpIAIFFXohXszQUHT

Scale = 1:24.8

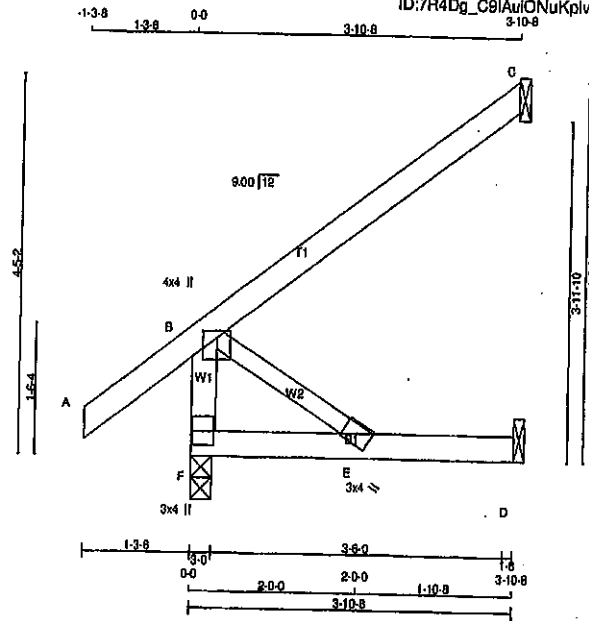

LUMBER			
N.L.G.A. RULES	SIZE	DRY	No.2
CHORDS	2x4	DRY	No.2
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
E	BMVW+p	MT20	3.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS	REACTION	GROSS	REACTION	BRG	IN-SX	BRG	IN-SX
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	BRG	IN-SX
F	340	0	340	0	0	3-0	3-0
C	178	0	178	0	0	1-8	1-8
D	36	0	40	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		MAX/MIN COMPONENT REACTIONS	
1ST CASE	SNOW	LIVE	PERM LIVE
JT	COMBINED	SNOW	LIVE
F	238	170/0	0/0
C	122	99/0	0/0
D	29	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LOI	MEMB.	FORCE (LBS)	MAX. FACTORED	CSI (LC)
FR-TO		FROM	TO	FR-TO			
F-B	-304/0	0.0	0.0	0.03 (1)	7.81	B-E	0/0
A-B	0/38	-91.8	-91.8	0.14 (5)	10.00		
B-C	0/0	-91.8	-91.8	0.23 (1)	10.00		
F-E	0/0	-18.5	-18.5	0.08 (4)	10.00		
E-D	0/0	-18.5	-18.5	0.08 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/380$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/380$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.01")

OSI: TC=0.23/1.00 (B-C:1), BC=0.08/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PS) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1867 1668

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (B) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006178

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408158	J20	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 15:04:44 2020 Page 1
 ID:7R4Dg_C8IAuIONuKplv?nzzlwO4-at8wEV_J_hKXCmkL6tyx46dQCHtHsfz3WzUnzQSAAn
 1-10-15 2-10-8 11-9

Scale = 1:27.8

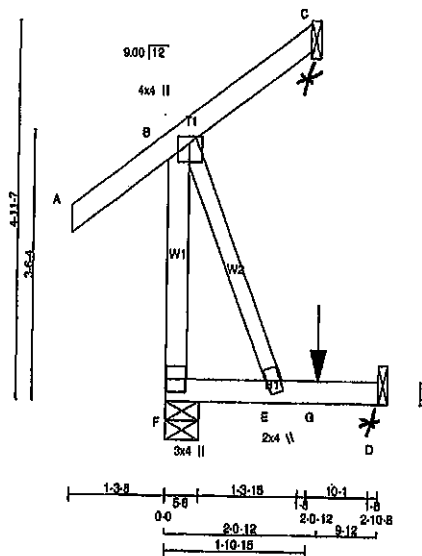

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4 DRY	No.2		
A - C	2x4 DRY	No.2		
F - D	2x4 DRY	No.2		
ALL WEBS	2x3 DRY	No.2		
DRY: SEASONED LUMBER.				

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMW+p	MT20	4.0	4.0	1.00	2.00
E	BMW+w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	RECORD BRG IN-SX
JT	VERT	HORZ	DOWN	HORZ
F	288	0	288	0
C	42	0	42	0
D	31	0	35	0

SEE MTEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED							
F	202	145 / 0	0 / 0	0 / 0	0 / 0	0 / 0	57 / 0	0 / 0
C	29	23 / -25	0 / 0	0 / 0	0 / 0	0 / 0	5 / 0	0 / 0
D	25	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	25 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED MAX. LC1 MAX. CS1 (LC)	MAX. UNBRACED LENGTH	WEBS	MAX. FACTORED MEMB. FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO			FR-TO		
F-B	-280 / 0	0.0	0.0	0.05 (1)	7.81	0 / 0	0.00 (1)
A-B	0 / 38	-91.8	-91.8	0.14 (5)	10.00		
B-C	-27 / 0	-91.8	-91.8	0.13 (5)	8.25		
F-E	0 / 0	-18.5	-18.5	0.05 (4)	10.00		
E-G	0 / 0	-18.5	-18.5	0.05 (4)	10.00		
G-D	0 / 0	-18.5	-18.5	0.05 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	2-0-12	-6	-6	...	BACK	VERT	TOTAL	...	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 14 = 28 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.8 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012, ABC 2018
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
 - OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19')
 CALCULATED VERT. DEFL.(LL) = L/899 (0.00')
 ALLOWABLE DEFL.(TL) = L/360 (0.19')
 CALCULATED VERT. DEFL.(TL) = L/899 (0.00')

CS1: TO=0.14/1.00 (A-B.5), BC=0.05/1.00 (D-E.4), WB=0.00/1.00 (B-E.1), SS=0.09/1.00 (A-B.5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	818	354	1667	768	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.21 (B) (INPUT = 0.90)
 JSI METAL= 0.05 (B) (INPUT = 1.00)

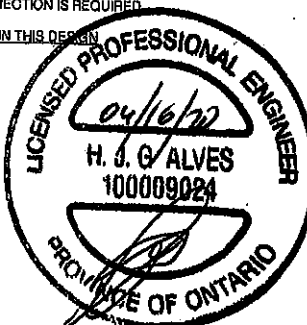

Structural component only
 DWG# T-2006195

JOB NAME 408158	TRUSS NAME J21	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 18:04:45 2020 Page 1
 ID:7R4Dg_C9IAuiONuKplv?nzzlwO4-24gIRr?xi?SOqwxJgaUAdJAd4pobV6HAJQ0DzQSAm
 24-7 2-5-8
 Scale = 1:27.7

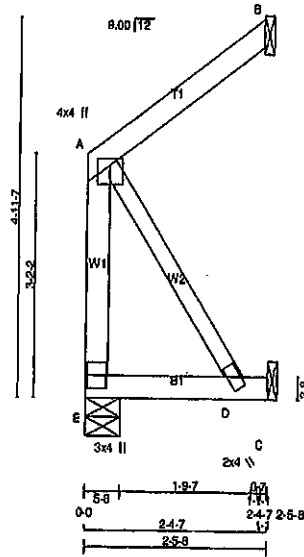

LUMBER			
N.L.G.A. RULES	CHORDS	SIZE	LUMBER
E - A	2x4	DRY	No.2
A - B	2x4	DRY	No.2
E - C	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (Tables in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW+p	MT20	4.0	4.0	1.00 2.00
D	BMW+ww	MT20	2.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	131	0	131	0	0	5-8	5-8
B	109	0	109	0	0	1-8	1-8
C	23	0	25	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	93	81/0	0/0	0/0	0/0	32/0	0/0
B	75	61/0	0/0	0/0	0/0	14/0	0/0
C	18	0/0	0/0	0/0	0/0	18/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, B

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	FORCE (LBS)	MAX. FACTORED (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO		FR-TO			
E-A	-109/0	0.0 0.0 0.02 (1)	7.81	A-D	0/0	0.00 (1)	
A-B	0/0	-91.8 -91.8 0.09 (1)	10.00				
E-D	0/0	-18.5 -18.5 0.03 (4)	10.00				
D-C	0/0	-18.5 -18.5 0.02 (4)	10.00				

TOTAL WEIGHT = 2 X 12 = 24 lb

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.8 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2010, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPO 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
 CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
 ALLOWABLE DEFL. (TL) = L/360 (0.19")
 CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.08/1.00 (A-B:1), EC=0.03/1.00 (D-E:4), WB=0.00/1.00 (A-D:1), SS=0.07/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.08 (A) (INPUT = 0.90)
 JSI METAL = 0.02 (A) (INPUT = 1.00)

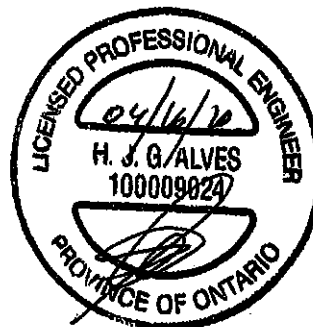

Structural component only
 DWG# T-2006196

JOB NAME 408159	TRUSS NAME J31	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Pool Truss, Burlington				TRUSS DESC.	

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 12:51:34 2020 Page 1
ID:MTW7E0QKerW7Mm2iBLF?kzlsx?-WkKNISemgDetwI2qcGFAI7usVCopfmRV42uzQU7d

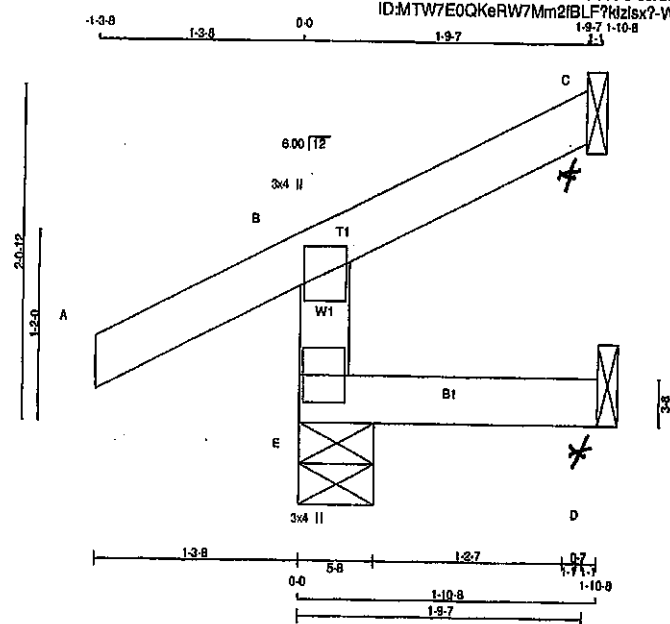

Scale = 1:13.1

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESOR.
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
E	271	0	271	0	5-8
C	45	0	45	0	-23
D	8	0	17	0	-2

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS		1ST CASE	MAX/MIN COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	168	141/0	0/0	0/0	0/0	47/0	0/0
C	31	24/-18	0/0	0/0	0/0	7/0	0/0
D	7	0/-8	0/0	0/0	0/0	12/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO		FROM TO	LENGTH FR-TO
E-B	-244/0	0.0	0.04 (5)
A-B	0/28	-91.8	-91.8 0.12 (1)
B-C	-17/0	-91.8	-91.8 0.09 (1)
E-D	0/0	-18.5	-18.5 0.04 (5)

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.18")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.18")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5), WB=0.00/1.00 (A-B:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP (DRY)	SHEAR	SECTION	
(PS)	(PL)	(PL)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1687 788	1987 1650

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)

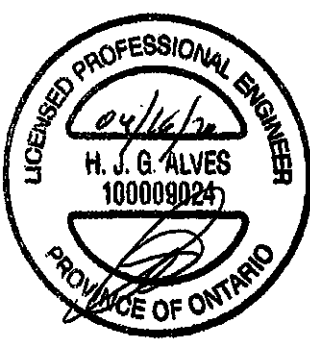

Structural component only
DWG# T-2006204

Tamarack Roof Truss, Burlington



DRY: SEASONED LUMBER.

DESCI
SPF
SPF
SHE

TOTAL WEIGHT = $5 \times 10 = 48 \text{ lb}$

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.8	PSP
	DL =	6.0	PSP
BOT CH.	LL =	0.0	PSP
	DL =	7.4	PSP
TOTAL LOAD	=	39.0	PSP

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/899$ (0.007")

ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PLI)		(PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	818	354	1067	788	1887 1856

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (E) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)



JOB NAME 408159	TRUSS NAME J33	QUANTITY 3	PLV 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 9 Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 12:51:37 2020 Page 1
 ID:MTW7E0QKerW7Mm2/BLF7Kizsx?-xj?VxTKLwh3oVL1ljzAztKw74UL71OLSOjklDzQU7a

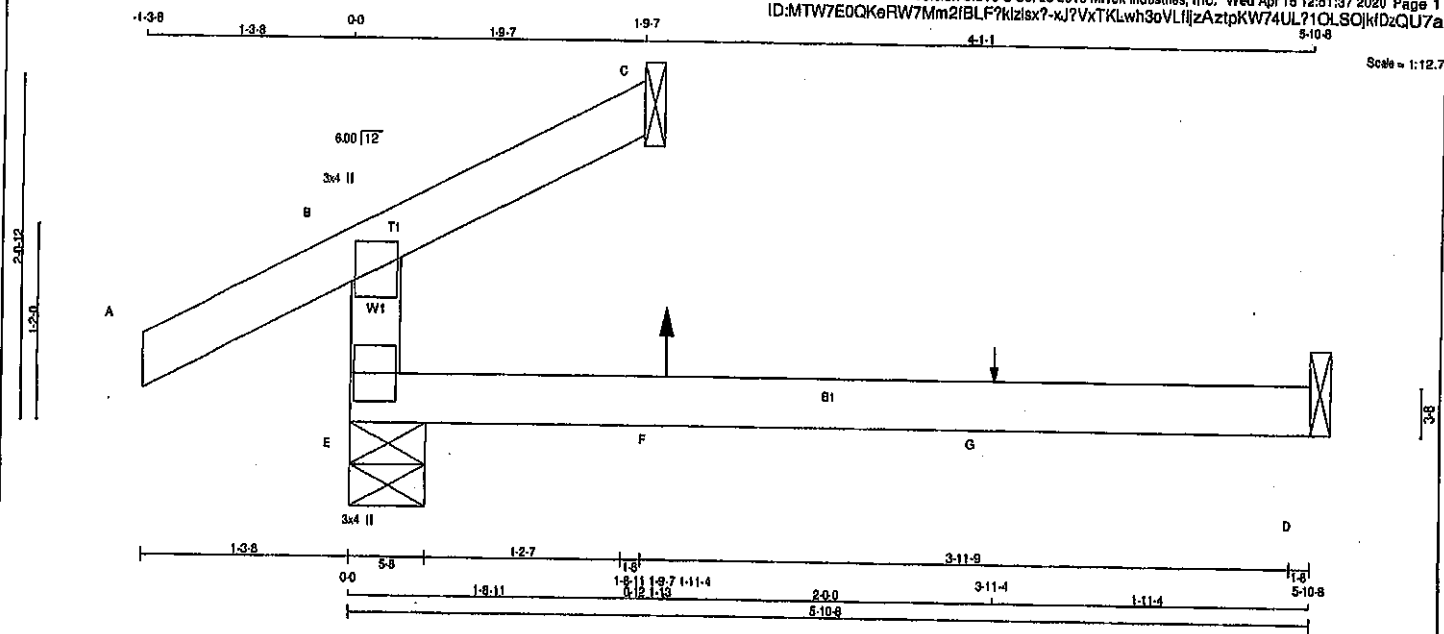

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	284	0	284	0	5-8	5-8
C	63	0	63	0	1-8	1-8
D	44	0	52	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	200	137/0	0/0	0/0	0/0	62/0	0/0
C	46	21/0	0/0	0/0	0/0	25/0	0/0
D	35	0/-3	0/0	0/0	0/0	37/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (7)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)
FR-TO	-227/0	0.0	0.0	0.11 (4)
E-B	0/28	-91.8	-91.8	0.12 (1)
A-B	-9/9	-91.8	-91.8	0.08 (4)
B-C				
E-F	0/0	-18.5	-18.5	0.14 (4)
F-G	0/0	-18.5	-18.5	0.14 (4)
G-D	0/0	-18.5	-18.5	0.14 (4)

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11-4	7	1	12	FRONT	VERT	TOTAL	--	C1
G	3-11-4	1	1	---	FRONT	VERT	TOTAL	--	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012, ABC 2018
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 088-08, CSA 088-14
 - TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
 - OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
 ALLOWABLE DEFL.(TL) = L/360 (0.20")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4), WB=0.00/1.00 (A-B:0), SS=0.09/1.00 (A-B:1)

DOL LUMBER=0.99 NAIL=0.99 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 818 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
 JSI METAL= 0.08 (B) (INPUT = 1.00)




Structural component only
 DWG# T-2006206

JOB NAME 408159	TRUSS NAME J34	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310.9 Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 12:51:38 2020 Page 1
ID:MTW7E0QKerW7Mm2IBLF7Klzlax7-PVZi8pLzh7B7VEVHghCQ0HFTagkUeVg2TIBfzQU7Z

Scale = 1:17.7

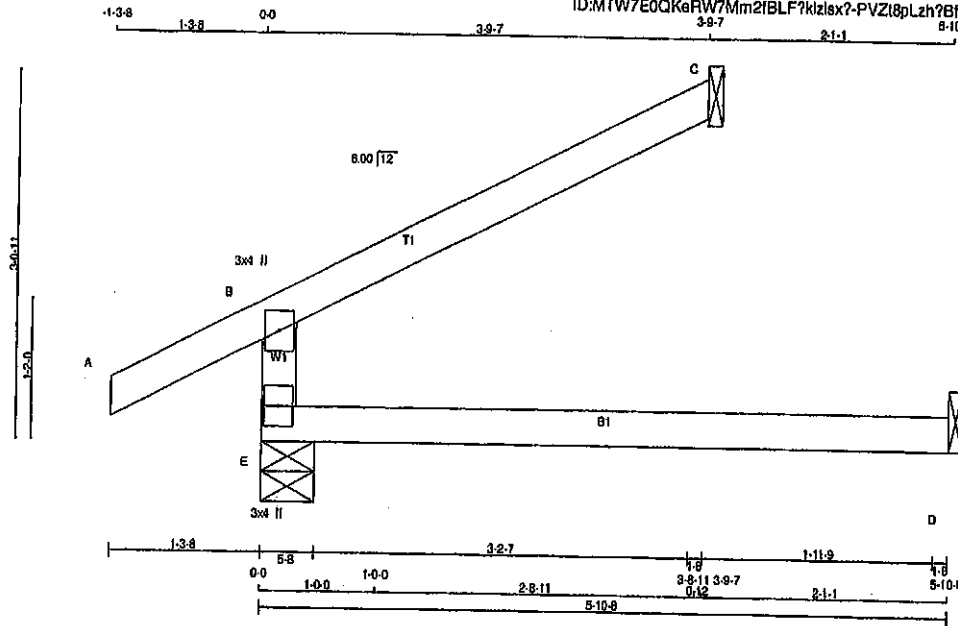

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y
B	TMV4p	MT20	3.0	4.0	X
E	BMV14p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
E	405	0	405	0	5-8
C	130	0	130	0	1-8
D	45	0	50	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
E	266	190 / 0	0 / 0
C	90	73 / 0	0 / 0
D	36	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)
E-B	-342 / 0	0.0	0.0
A-B	0 / 28	-91.8	-91.8
B-C	-19 / 0	-91.8	-91.8
E-D	0 / 0	-18.5	-18.5

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, NBCC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/899 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/899 (0.03")

CS: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (A-B:0), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	(PL)
MAX	MIN	MAX	MIN
MT20	618	354	1087

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


SI GRIP=0.14 (E) (INPUT = 0.80)
SI METAL=0.09 (B) (INPUT = 1.00)

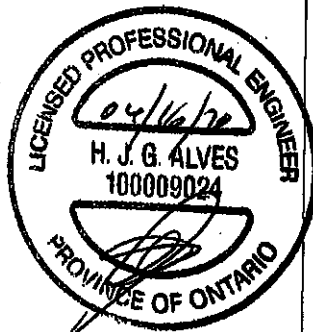

Structural component only
DWG# T-2006207

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408159	J35	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 8 Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 12:51:39 2020 Page 1
ID:MTW7E0QKRW7Mm2tBLF7kizax7-ii7GM9MbSIJvkaohrNCRyEPatCyTxueviCrj8zQU7Y

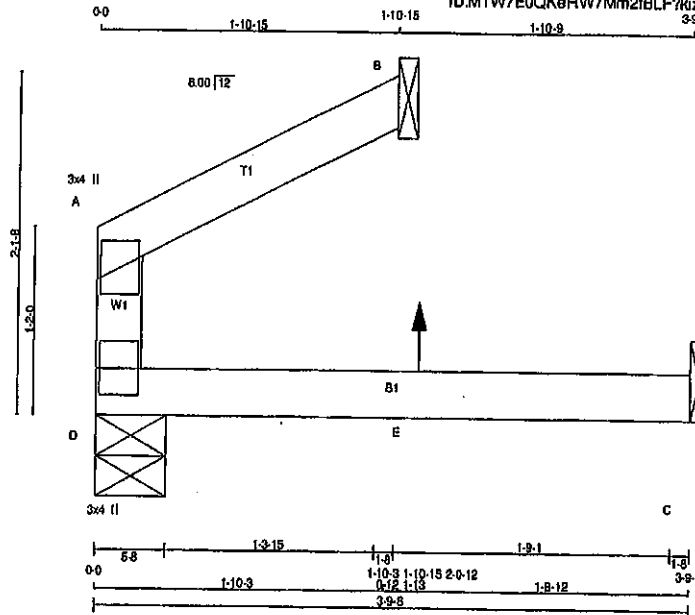

Scale = 1:13.2

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
D - A	2x4	DRY	No.2		
A - B	2x4	DRY	No.2		
D - C	2x4	DRY	No.2		

DRY, SEASONED LUMBER.

PLATES (table in inches)	W	LEN	Y	X
JT TYPE PLATES				
A TMV+p MT20	3.0	4.0		
D BMV+p MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
D	119	0	119	0
B	89	0	89	0
C	31	0	35	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS	1ST LCASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	SNOW
D	88	49.0
B	62	45.0
C	25	0.2

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D, B

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (7)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	WESS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. (PLF)	CSI (LC)	UNBRAC	LENGTH	FR-TO	FORCE (LBS)
D-A	-87.0	0.0	0.0	0.03 (4)	7.81		
A-B	0.3	-91.8	-91.8	0.06 (1)	10.00		
D-E	0.0	-18.5	-18.5	0.06 (4)	10.00		
E-C	0.0	-18.5	-18.5	0.06 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	2-0-12	7	1	12	BACK	VERT	TOTAL			C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 8 lb (MIF)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2016, CBC 2012, ABC 2019
- PART 8 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.08/1.00 (A-B:1), BC=0.08/1.00 (C-D:4), WB=0.00/1.00 (n/a:0), SS=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 786 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.04 (D) (INPUT = 0.90)
JSI METAL= 0.02 (A) (INPUT = 1.00)

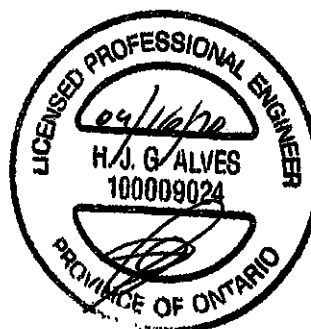

Structural component only
DWG# T-2006208

JOB NAME 408159	TRUSS NAME J39	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tantarak Roof Truss, Burlington					

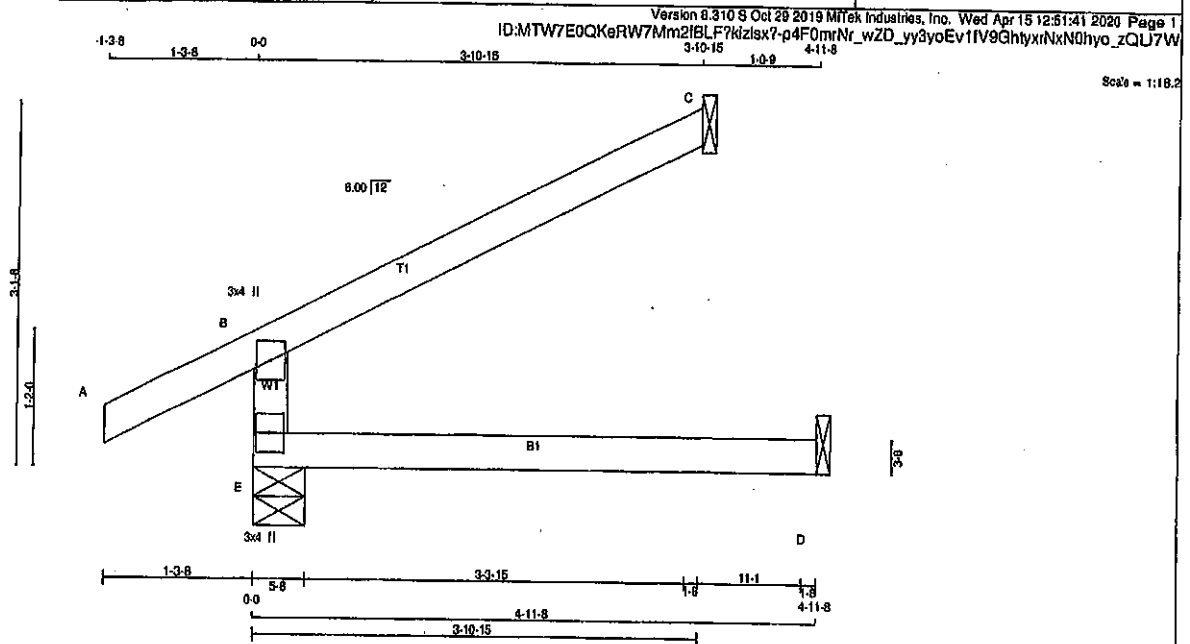

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY; SEASONED LUMBER.

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DESCR.
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
E	402	0	402	0
C	135	0	135	0
D	38	0	43	0

SEE MITEK STANDARD DETAIL B97781H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	283	194 / 0	0 / 0	0 / 0	68 / 0	0 / 0	0 / 0
C	93	75 / 0	0 / 0	0 / 0	18 / 0	0 / 0	0 / 0
D	31	0 / 0	0 / 0	0 / 0	31 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
E-B	-349 / 0	0.0	0.09 (4)	7.81			
A-B	0 / 28	-91.8	-81.8	0.12 (1)	10.00		
B-C	-20 / 0	-91.8	-81.8	0.24 (1)	8.25		
E-D	0 / 0	-18.5	-18.5	0.09 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 8, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 8 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/899$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/899$ (0.02")

CSI: TC=0.24/1.00 (B-C:1), BC=0.09/1.00 (D-E:4), WB=0.00/1.00 (NA:0), SSI=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LG BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	818	354	1887
	788	1887	1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.16 (E) (INPUT = 0.80)
JSI METAL = 0.10 (B) (INPUT = 1.00)

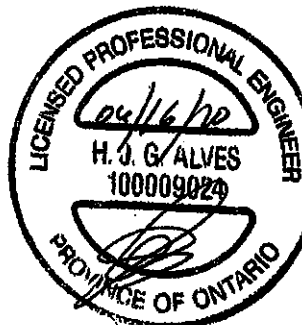


Structural component only
DWG# T-2006210

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408159	J41	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S O; 29 2019 Mitak Industries, Inc. Wed Apr 15 12:51:42 2020 Page 1
ID:MTW7E0QKerW7Mm2tBLF7kizlex7-HI-pO_BOUIDh4b8XGWWI8as1lv5A_gld4bgRVKQzQU7V

Scale = 1:10.0

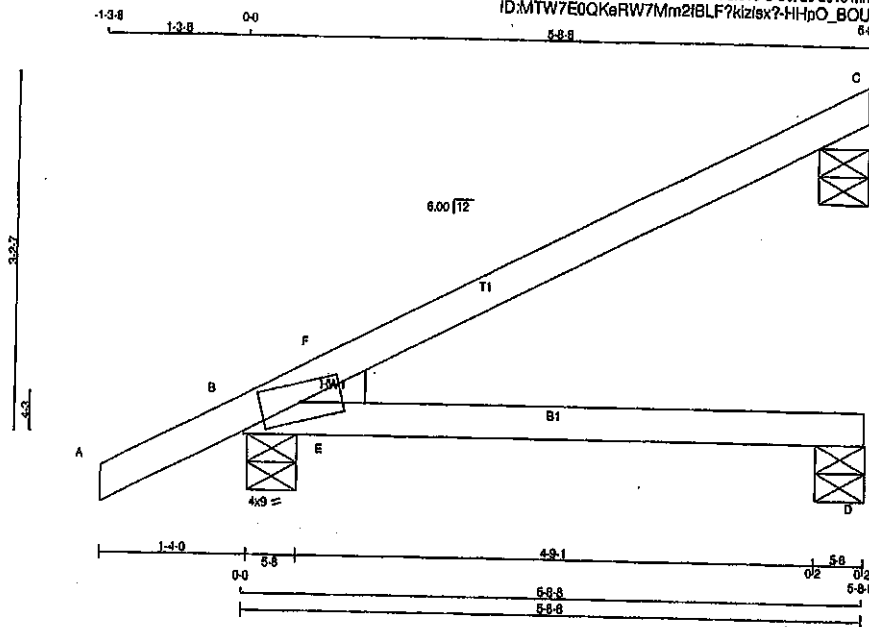

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
B - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMBH1-m	MT20	4.0	9.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECORD BRG IN-SX	HEEL WEDGE
	VERT	HORZ	DOWN	HORZ			
C	225	0	225	0	5-8 (5-7)	5-8	
B	439	0	439	0	5-8	5-8	2x4 L
D	90	0	90	0	5-8 (5-5)	5-8	

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
C	158	121/0	0/0	0/0	0/0	35/0	0/0
B	308	215/0	0/0	0/0	0/0	93/0	0/0
D	67	25/0	0/0	0/0	0/0	42/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	E-F	-254 / 6
B-F	-22 / 0	-91.8	-91.8	0.08 (4)	8.25		0.00 (1)
F-C	0 / 4	-91.8	-91.8	0.37 (1)	10.00		
B-E	0 / 0	-18.5	-18.5	0.30 (1)	10.00		
E-D	0 / 0	-18.5	-18.5	0.30 (1)	10.00		

TOTAL WEIGHT = 3 X 16 = 48 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/998$ (0.07")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/500$ (0.14")

CSI: TO=0.37/1.00 (C-F:1), BC=0.30/1.00 (B-E:1),
WB=0.00/1.00 (E-F:1), SSI=0.21/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
	MAX	MIN
MT20	618	354
	1687	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (B) (INPUT = 0.90)
JSI METAL= 0.03 (B) (INPUT = 1.00)

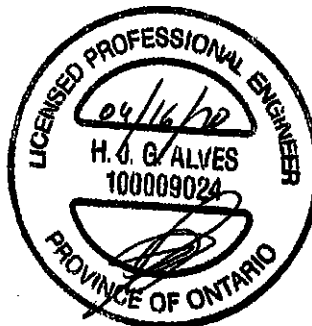

Structural component only
DWG# T-2006211

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.


Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.

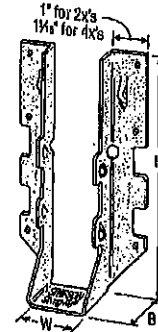


LUS28




LU28L

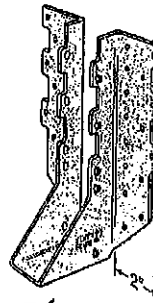

HUS210
(HUS26, HUS28, and HHUS similar)



HGUS28-2



HHUS210-2



Double-Shear Nailing Top View





Double-Shear Nailing Side View; Do not bend tab



Dome Double-Shear Nailing Side View (available on some models)
U.S. Patent 5,603,580

Typical HUS26 Installation with Reduced Heel Height (Truss Designer to provide fastener quantity for connecting multiple members together)

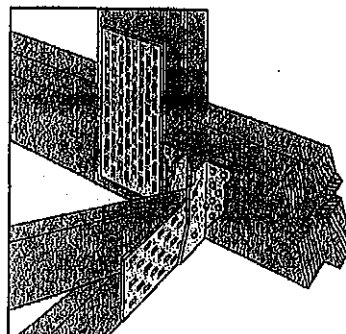

LJS26DS

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options information on pp. 125-127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value

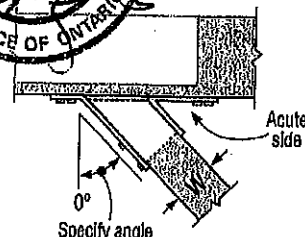

Top View HHUS Hanger Skewed Right
(joist must be bevel cut)
All joist nails installed on the outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance				
		W	H	B	d _o ¹	Header	Joist	D-Fir-L		S-P-F		
								Uplift	Normal	Uplift	Normal	
								(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)	
								lb.	lb.	lb.	lb.	
								kN	kN	kN	kN	
Single 2x Sizes												
■	LUS24	18	1 1/8	3 1/4	1 1/4	2 1/2	(4) 10d	(2) 10d	710	1825	645	1155
									3.16	7.23	2.87	5.14
■	LU24L	22	1 1/8	3	1 1/4	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360	1020	320	725
									1.60	4.54	1.42	3.22
■	LU26L	22	1 1/8	5	1 1/4	4 1/4	(6) 10d	(4) 10d x 1 1/2"	720	1605	646	1140
									3.20	7.14	2.87	5.07
SS	LUS26	18	1 1/8	4 1/4	1 1/4	3 1/4	(4) 10d	(4) 10d	1420	2170	1290	1830
									6.32	9.65	5.74	7.25
■	HUS26	16	1 1/8	5 1/4	3	3 1/8	(14) 10d	(6) 18d	2705	4940	2065	3675
									11.30	21.97	9.20	17.24
■	LJS26DS	18	1 1/8	5	3 1/2	4 1/4	(16) 18d	(6) 16d	2055	4265	1480	4115
									9.14	18.97	6.49	18.31
■	HGUS26	12	1 1/8	6 1/4	5	4 1/4	(20) 16d	(8) 16d	2885	6825	2685	5700
									11.98	29.51	11.98	25.35
■	LU28L	20	1 1/8	8 1/4	1 1/4	5 1/4	(8) 10d	(8) 10d x 1 1/2"	1140	2185	1020	1550
									5.07	9.72	4.54	6.89
SS	LUS28	18	1 1/8	6 1/4	1 1/4	3 1/4	(6) 10d	(4) 10d	1420	2920	1290	1790
									6.32	11.21	5.74	7.96
■	HUS28	16	1 1/8	7 1/4	3	6 1/8	(22) 18d	(8) 16d	3605	5365	2675	4345
									16.04	23.88	11.90	19.33
■	HGUS28	12	1 1/8	7 1/4	5	6 1/4	(36) 16d	(12) 16d	3310	7675	3310	6900
									14.74	34.10	14.74	30.73
■	LU210L	20	1 1/8	8	1 1/4	7 1/4	(10) 10d	(8) 10d x 1 1/2"	1140	2495	1020	1770
									5.07	11.10	4.54	7.87
SS	LUS210	18	1 1/8	7 1/4	1 1/4	3 1/4	(8) 10d	(4) 10d	1420	2785	1290	2210
									6.32	12.39	5.74	9.83

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.

2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.

3. d_o is the distance from the bearing seat to the top joist nail.

4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.

5. Nails: 16d = 0.162" dia. x 3 1/4" long. See pp. 27-28 for other nail sizes and information.

Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ²	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb.	(K _D = 1.00) lb.	(K _D = 1.15) lb.	(K _D = 1.00) lb.
Double 2x Sizes											
LUS24-2	18	3 1/8	3 1/8	2	1 1/2	(4) 16d	(2) 16d	835	2020	590	1435
SS LUS26-2	18	3 1/8	4 1/8	2	4	(4) 16d	(4) 16d	3.71	8.99	2.62	6.38
								1720	2595	1545	1920
HHUS26-2	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	7.65	11.54	8.87	8.64
								2850	7335	2065	5205
HGUS26-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	12.68	32.63	9.20	23.15
								4385	8950	3110	6355
SS LUS28-2	18	3 1/8	7	2	4	(8) 16d	(4) 16d	18.51	39.81	13.83	28.27
								1720	3325	1545	2575
HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	7.85	14.79	8.87	11.45
								3765	8940	2875	6345
HGUS28-2	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	16.76	39.77	11.90	28.22
								6070	12980	4310	9215
SS LUS210-2	18	3 1/8	9	2	6	(8) 16d	(8) 16d	27.00	57.74	19.17	40.99
								2580	4500	2320	3195
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d	11.48	20.02	10.32	14.21
								4670	9600	4235	7000
HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(48) 16d	(16) 16d	20.77	42.97	18.84	31.14
								6840	14015	4855	10270
								30.43	62.34	21.60	45.09
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/2	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-3	12	4 1/8	7 1/4	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	4670	9670	4235	6865
								20.77	43.02	18.84	30.54
HGUS210-3	12	4 1/8	9 1/4	4	8 1/8	(48) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.28
Quadruple 2x Sizes											
HGUS26-4	12	6 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-4	14	8 1/8	8 1/8	3	7 1/8	(30) 16d	(10) 16d	4670	10155	4235	7210
								20.77	45.17	18.84	32.07
HGUS210-4	12	6 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
HGUS212-4	12	6 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7840	14995	5425	10645
								33.98	66.70	24.13	47.35
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80
4x Sizes											
LUS46	18	3 1/8	4 3/4	2	3 1/8	(4) 16d	(4) 16d	1720	2595	1545	1920
								7.65	11.54	8.87	8.64
HHUS46	14	3 1/8	5 1/4	3	3 1/8	(14) 16d	(6) 16d	2640	7335	2065	5205
								11.30	32.63	9.20	23.15
HGUS46	12	3 1/8	5 1/4	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
LUS48	18	3 1/8	6 3/4	2	3 1/8	(6) 16d	(4) 16d	1720	3325	1545	2575
								7.65	14.79	8.87	11.45
HHUS48	14	3 1/8	7 1/4	3	6 1/8	(22) 16d	(8) 16d	3765	8940	2875	6345
								16.76	39.77	11.90	28.22
HGUS48	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
LUS410	18	3 1/8	8 3/4	2	5 1/8	(8) 16d	(6) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HGUS410	12	3 1/8	9	4	8 1/8	(46) 16d	(16) 16d	6840	14015	4855	45.69
								30.43	62.34	21.60	
HGUS412	12	3 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10645
								33.98	66.70	24.13	47.35
HGUS414	12	3 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.08	72.95	32.00	51.80



Plated Truss Connectors

See footnotes
on p. 268.

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

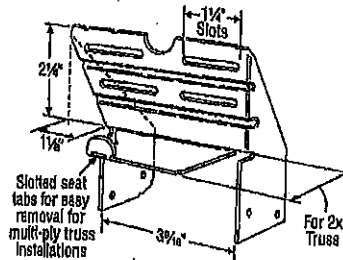


TC24
U.S. Patent 4,932,173

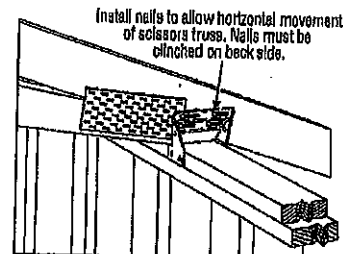


Typical TC24 Installation

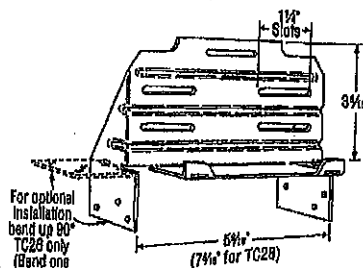

TC26
(TC28 Similar)

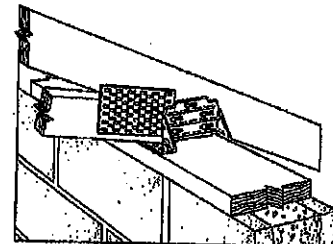

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer
(8", 10", 12" Wall Installation Similar)

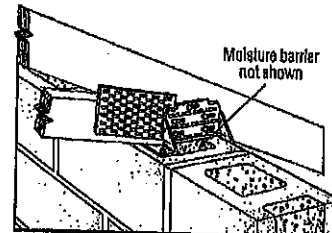

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _o =1.18)	Uplift (K _o =1.16)
TC24	(4) 10d	(4) 10d	605	430
TC26	(6) 10d	(6) 10d	1015	720
TC28	(6) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _o =1.15)	Uplift (K _o =1.15)
TC26	(5) 10d	(8) 10d x 1 1/2"	810	660
	(5) 10d	(8) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.

2. Grout strength is 15 MPa minimum.

3. Optional TC26 Installation with 10d nails requires minimum 3" top plate thickness.

4. TC26 fastened to grouted concrete block with (6) - 3/8" x 2 1/4" Titen screws has a factored uplift resistance of 276 lb.



(800) 999-5099
strongtie.com

H/TSP

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_D = 1.15$)					
		To Rafter/Truss	To Plates	To Studs	D.Fir-L			S-P-F		
					Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(8) 8d x 1½"	(4) 8d	—	740	685	300	680	485	215
					3.29	3.05	1.33	3.02	2.16	0.96
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	76	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	180	160	765	180	160
					3.58	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	265	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	18	—	(8) 8d	(8) 8d	1595	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	870	—	990	475	—
					6.18	2.88	—	4.40	2.11	—
SS H8*	18	(5) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.58	—	—
SS H10A ^u	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	585	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^{1,2}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1465	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(8) 18d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.08	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
		[2] (12) 8d x 1½"	(15) 8d	—	10.63	3.80	1.42	8.03	2.71	1.02
TSP	18	(8) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
		(9) 10d x 1½"	(6) 10d	—	5.76	1.96	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1580	440	—	1105	310	—
					6.94	1.96	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.162" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27–28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

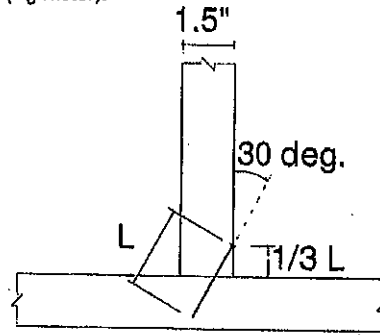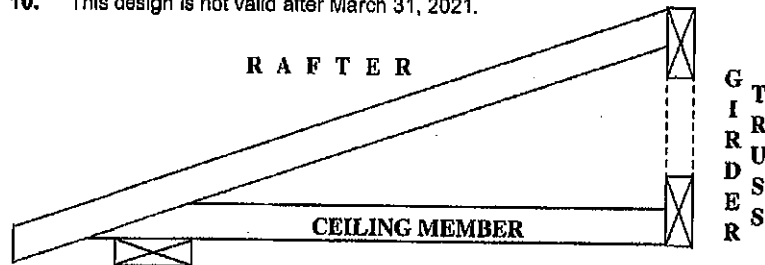


TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (In)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to wind or earthquake load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: G = 0.42(SPF), G = 0.49(D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

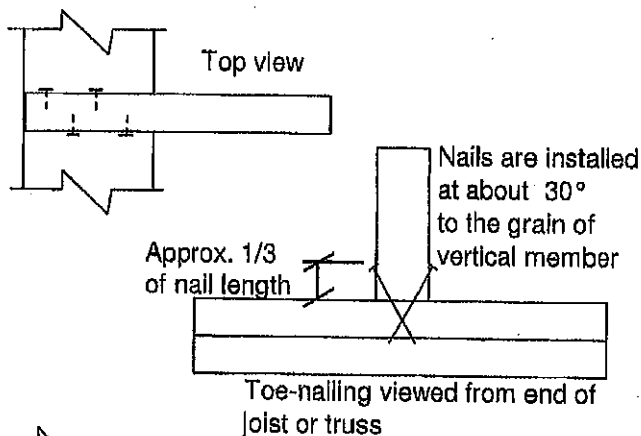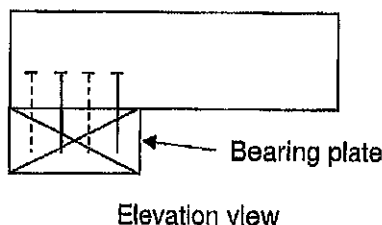

Toe-nailing on 2x4 Bearing Plate

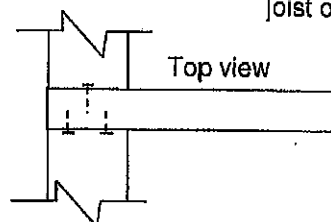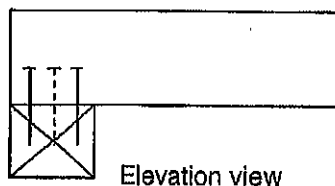


MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint, unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/8" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

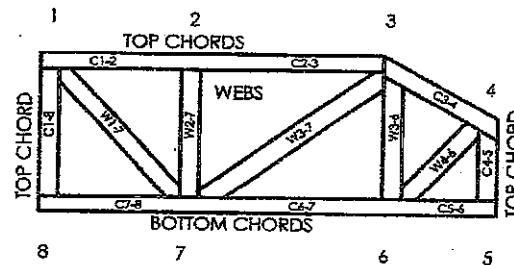

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MUK-7473C rev. 10-08



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane of joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected ovetop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

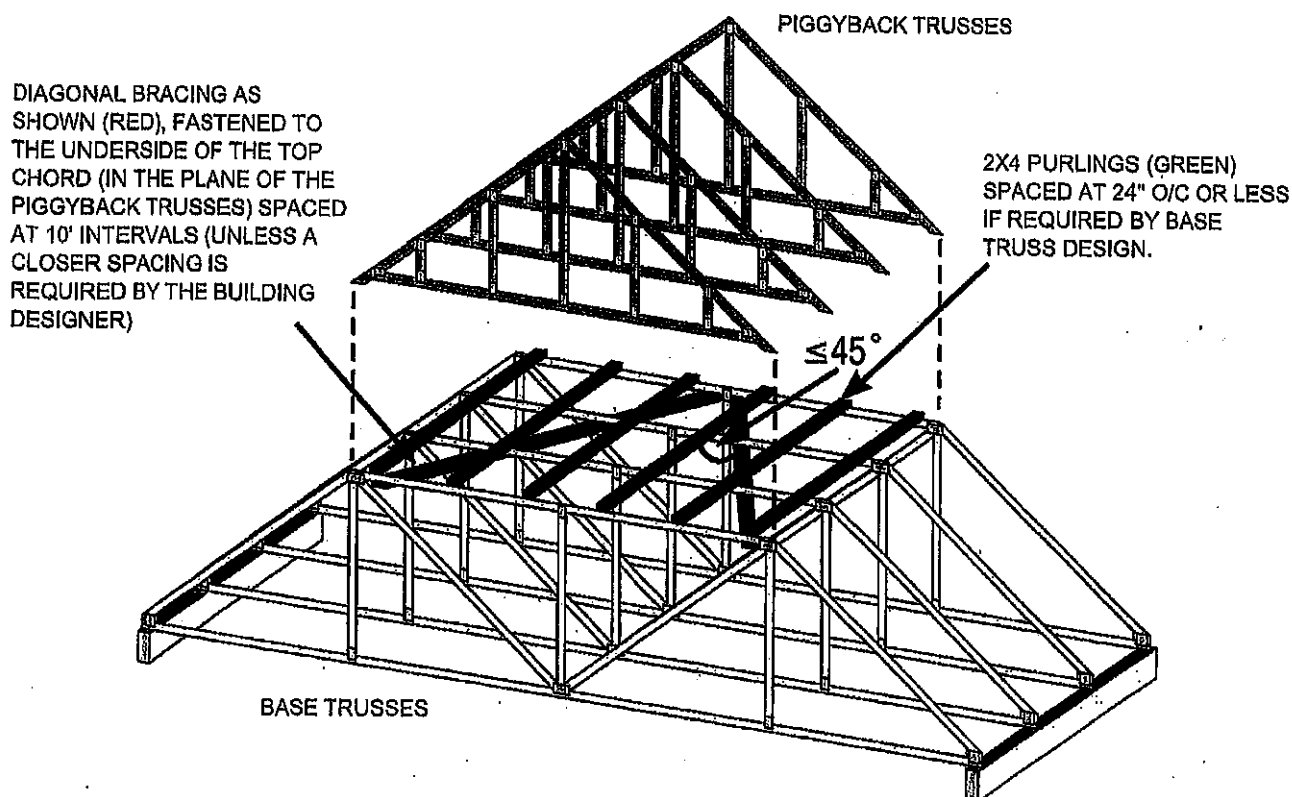

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufacturer's responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet M117473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1800213

Feb 09, 2018