


Permit No. 21-105911

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by
Gpc reb/ah

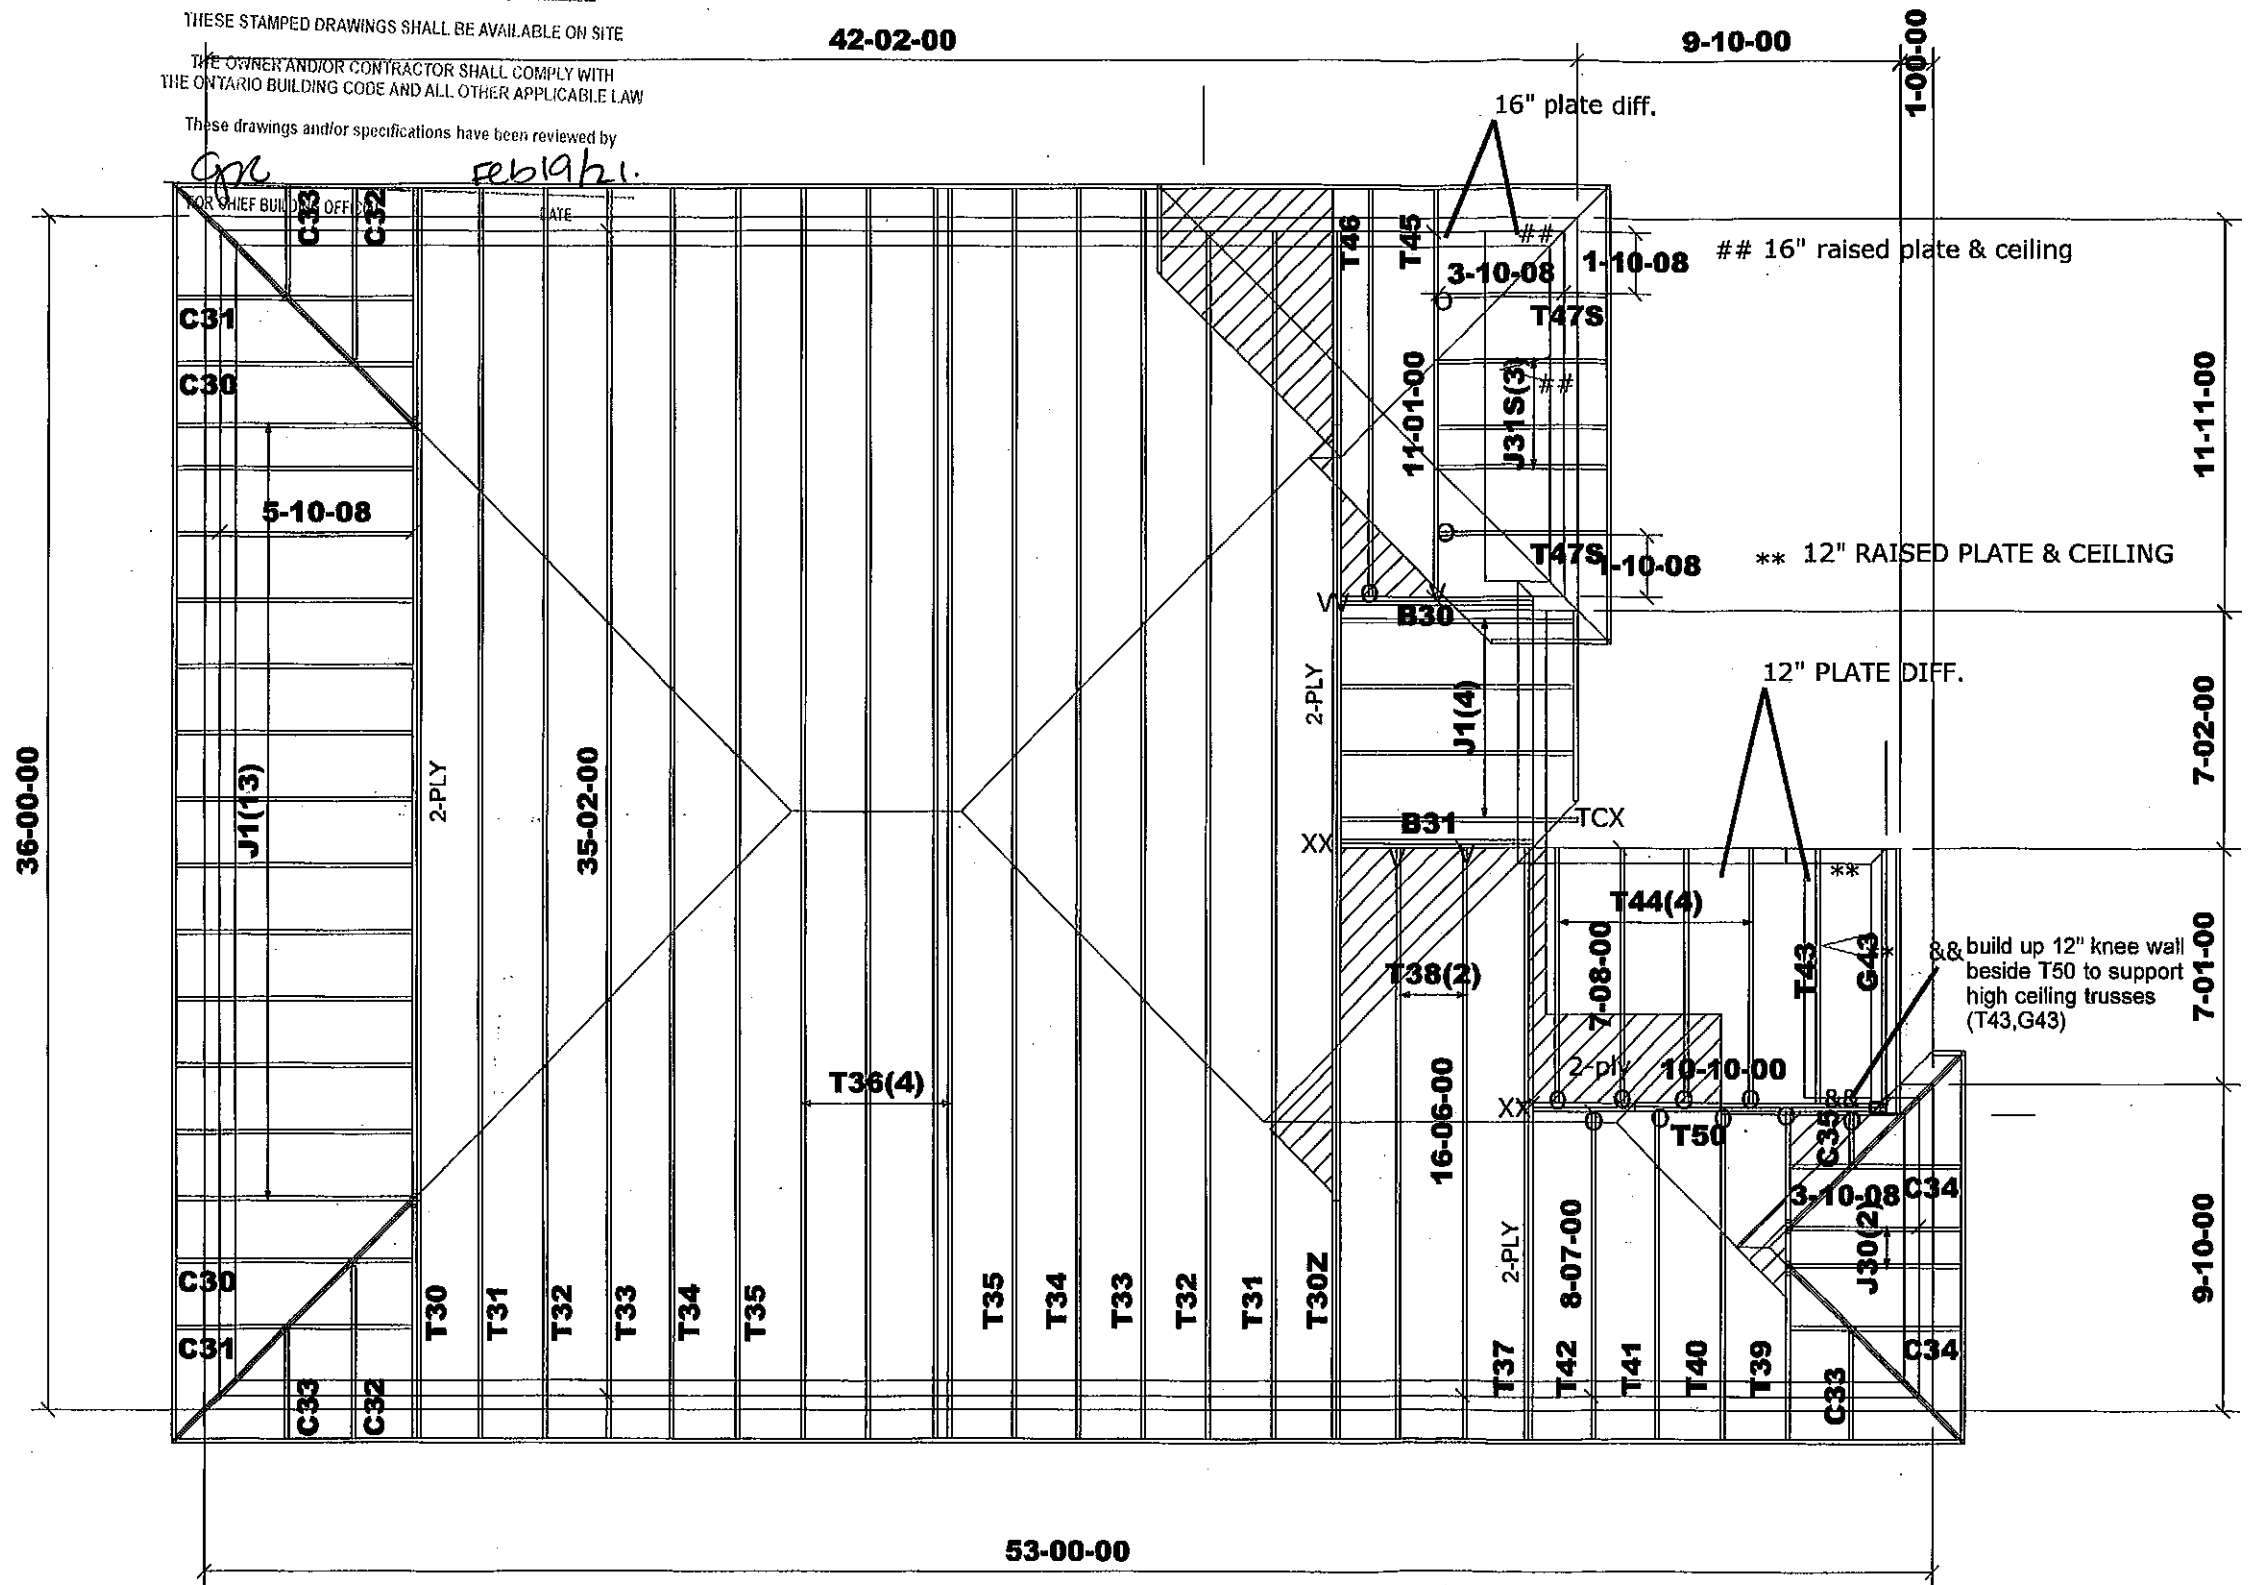

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.


All conventional framing to conform with
Part 9 of O.B.C. 2012 (2019 amendment).
Roof rafters that cross over or meet trusses
to be min. 2x4 SPF #2 @ 24" o/c with a
vertical post to the truss at each cross
point. Vertical posts longer than 6' to have
lateral bracing so that the distance between
the post end points and lateral bracing does
not exceed 6'.

DESIGN CONFORMS WITH OBC 2012
(2019 amendment) OCCUPANCY:
RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
LUS26-2-(VV)

BEAMS:
B30 = B31 =
2 - 2x10 SPF #2


 DENOTES:
CONVENTIONAL
FRAMING

CITY OF HAMILTON BUILDING DIVISION Planning & Development Department	
FEB 4 2021	
REC'D BY _____	DATE _____
REF'D TO _____	DATE _____

M13124



Job Track: 51225	Builder / Location: GREEN PARK HOMES / WATERDOWN	Model / Elevation: MOUNTAINASH 3/3- STD OR OPT.5 BR	File: Lot 155
Plan Log: 202395	Project: RUSSELL GARDENS PH.3	THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.	
Layout ID: 408133	Date: 2020-04-27	Sales: Mario DiCano	Designer: JG

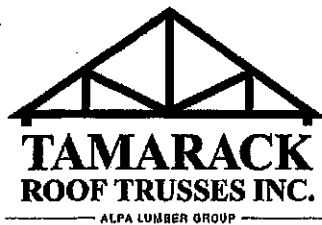

DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 3
 Lot #: 155
 Elevation: 3- STD OR OPT.5 BR




Job Track: 51225
 Plan Log: 202395
 Layout ID: 408133
 Ref #
 Page: 1 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T30 Hip Girder	6 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	337.66 208.00		
	1 2-ply	T30Z Hip Girder	6 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	337.66 208.00		
	2	T31 Hip	6 /12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.96 174.00		
	2	T32 Hip	6 /12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.1 174.67		
	2	T33 Hip	6 /12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	289.05 179.67		
	2	T34 Hip	6 /12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	290.71 183.33		
	2	T35 Hip	6 /12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	301.64 191.33		
	4	T36 Common	6 /12	35-02-00	9-11-08	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	606.72 372.00		
	1 2-ply	T37 Common Girder	6 /12	16-06-00	5-03-08	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	156.36 98.00		
	2	T38 Common	6 /12	16-06-00	5-03-08	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	132.54 82.67		
	1	T39 Hip Girder	6 /12	8-07-00	3-01-04	2 x 4	1-03-08	1-02-00 1-04-08	36.28 24.50		
	1	T40 Half Hip	6 /12	8-07-00	3-07-04	2 x 4	1-03-08	1-02-00 3-07-04	36.11 24.33		
	1	T41 Half Hip	6 /12	8-07-00	4-07-04	2 x 4	1-03-08	1-02-00 4-07-04	40.96 27.50		
	1	T42 Common	6 /12	8-07-00	5-03-08	2 x 4	1-03-08	1-02-00 5-01-08	37.97 24.00		


 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST							
	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 3 Lot #: 155 Elevation: 3- STD OR OPT.5 BR	Job Track: 51225 PlanLog: 202395 Layout ID: 408133 Ref #: Page: 2 of 3 Date: 04-27-2020 Designer: Sales Rep: Mario DiCano						

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T43 Flat	0 / 12	7-08-00	2-08-00	2 x 4		2-08-00 2-08-00	30.48 21.17		
	1	G43 GABLE	0 / 12	7-08-00	2-08-00	2 x 4		2-08-00 2-08-00	27.33 19.17		
	4	T44 Flat	0 / 12	7-08-00	3-08-00	2 x 4		3-08-00 3-08-00	138.2 92.00		
	1	T45 Hip Girder	6 / 12	11-01-00	4-05-04	2 x 4	1-03-08 1-03-08	2-06-00 2-06-00	51.48 34.17		
	1	T46 Hip	6 / 12	11-01-00	5-00-08	2 x 4	1-03-08 1-03-08	2-06-00 2-06-00	51.04 34.33		
	2	T47S Half Hip	6 / 12	3-10-08	3-05-04	2 x 4	1-03-08	1-02-00 3-05-04	48.24 33.00		
	1 2-ply	T50 Half Hip Girder	6 / 12	10-10-00	5-00-00	2 x 4 2 x 6		1-02-00 5-00-00	109.49 73.00		
	17	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	285.47 181.33		
	2	J30 Jack-Open	6 / 12	3-10-08	3-01-04	2 x 4	1-03-08	1-02-00 3-01-04	23.93 14.67		
	3	J31S Jack-Open	6 / 12	3-10-08	4-05-04	2 x 4	1-03-08	1-02-00 4-05-04	75.74 52.00		
	2	C30 Jack-Open	6 / 12	3-11-00	3-01-08	2 x 4	1-03-08 1-11-08	1-02-00 3-01-08	28.59 17.33		
	2	C31 Jack-Open	6 / 12	1-11-00	2-01-08	2 x 4	1-03-08 3-11-08	1-02-00 2-01-08	23.49 14.67		
	2	C32 Jack-Open	6 / 12	2-00-00	3-01-07	2 x 4	1-03-08 1-10-14	1-02-00 2-02-00	19.74 12.00		
	3	C33 Jack-Open	6 / 12	1-10-14	2-01-07	2 x 4	1-03-08 1-02	1-02-00 2-01-07	21.96 14.00		

 TAMARACK ROOF TRUSSES INC. ALFA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 3 Lot #: 155 Elevation: 3- STD OR OPT.5 BR	Job Track: 51225 PlanLog: 202395 Layout ID: 408133 Ref #: Page: 3 of 3 Date: 04-27-2020 Designer: Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	C34 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 1-11-09	1-02-00 2-01-08	18.92 12.00		
	1	C35 Jack-Open	6 /12	1-07-00	2-01-08	2 x 4		1-04-08 2-02-00	4.91 3.33		

TOTAL # TRUSS= 72 TOTAL BFT OF ALL TRUSSES= 2600.17 BFT. TOTAL WEIGHT OF ALL TRSSES 4119.53 LBS


HARDWARE

QTY	TYPE	MODEL	LENGTH
2	Hardware	HGUS26-2	
3	Hardware	LJS28DS	
12	Hardware	LUS24	
1	Hardware	LUS26-2	

TOTAL NUMBER OF
 ITEMS= 18

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408131	T1	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 5 Oct 2019 Mitek Industries, Inc. Sat Apr 25 10:07:23 2020 Page 1
ID:DMCubINVR6Tsf0e31v6l_zns1l-q_gwSdDL4SQFGEKdu6MrxTwqWC0rQSA0H0idzNDbY

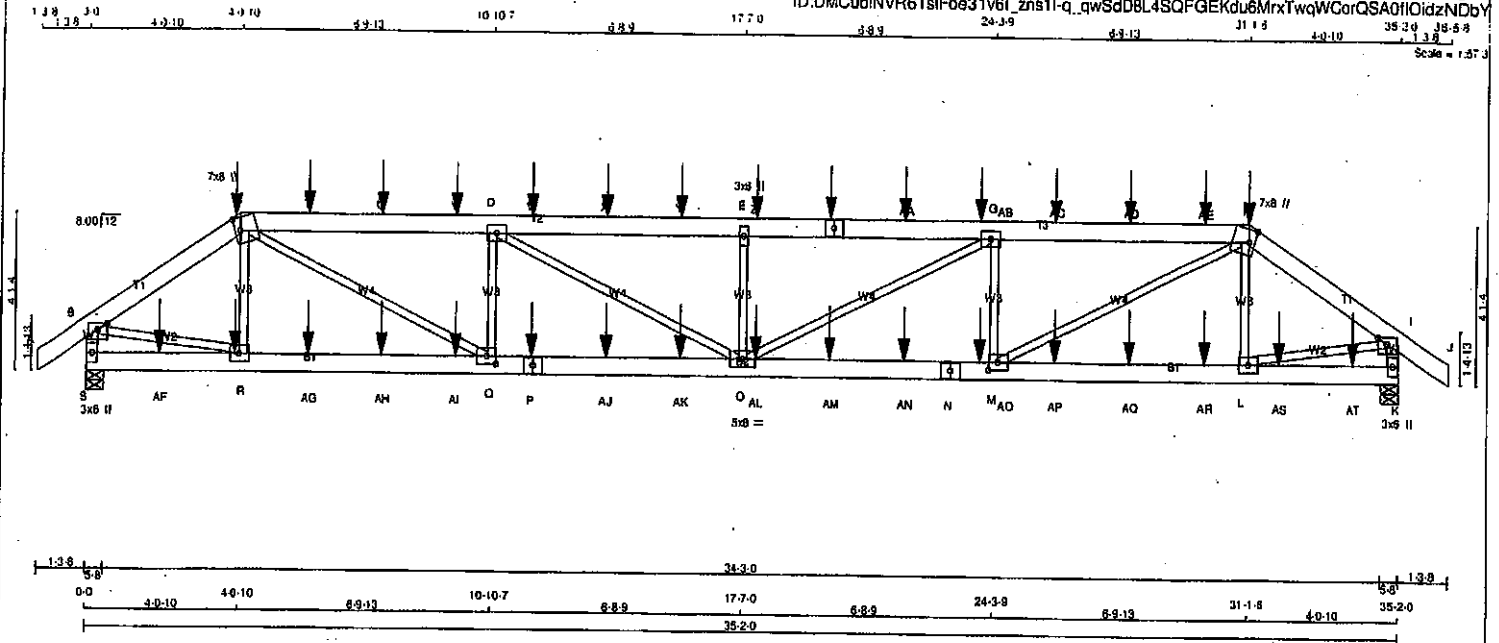

LUMBER		N. L. G. A. RULES			
CHORDS	SIZE		LUMBER	DESCR	
A - C	2x6	DRY	No.2	SPF	
C - F	2x6	DRY	No.2	SPF	
F - H	2x6	DRY	No.2	SPF	
H - J	2x6	DRY	No.2	SPF	
J - B	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
S - P	2x6	DRY	No.2	SPF	
P - N	2x6	DRY	No.2	SPF	
N - K	2x6	DRY	No.2	SPF	

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408131	T1	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 \$ Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 10:07:23 2020 Page 2
ID:DMCub\NVR6Tst\Foe31v6l zns11-q awSdD8L4SQFGEKdu6MrxTwqWCOrQSA0fIQdzNDby

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW-p	MT20	5.0	6.0	Edge	
C	TTWW+m	MT20	7.0	8.0	4.00	1.75
D	TMWW-l	MT20	5.0	8.0		
E	TMW-w	MT20	3.0	8.0		
F	TS-l	MT20	5.0	8.0		
G	TMWW-l	MT20	5.0	8.0		
H	TTWW+m	MT20	7.0	8.0	4.00	1.75
I	TMW-p	MT20	5.0	8.0	Edge	
K	BMV-l-p	MT20	3.0	8.0		
L	BMWW-l	MT20	5.0	8.0		
M	BMWW-l	MT20	5.0	8.0	2.50	2.75
N	BS-l	MT20	5.0	8.0		
O	BMWW-l	MT20	5.0	8.0		
P	BS-l	MT20	5.0	8.0		
Q	BMWW-l	MT20	5.0	8.0	2.50	2.75
R	BMWW-l	MT20	5.0	8.0		
S	BMV-l-p	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)

CHORDS


MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (LBS)	FACTORED LC1 MAX (LBS)	MAX. MEMB. FORCE (LBS)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. MEMB. FORCE (LBS)
FR-TO		FROM	TO	CS (LC)	UNBRAC	LENGTH	FR-TO
AR-L	0.3365	-18.5	-18.5	0.27 (1)	10.00		
L-AS	0.0	-18.5	-18.5	0.07 (4)	10.00		
AS-AT	0.0	-18.5	-18.5	0.07 (4)	10.00		
AT-K	0.0	-18.5	-18.5	0.07 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-10	-49	-55	---	FRONT	VERT	DEAD	---	C1
C	4-0-10	-117	-117	---	BACK	VERT	TOTAL	---	C1
C	4-0-10	-254	-254	---	FRONT	VERT	SNOW	---	C1
F	19-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
H	31-1-6	-49	-55	---	FRONT	VERT	DEAD	---	C1
H	31-1-6	-254	-254	---	FRONT	VERT	SNOW	---	C1
P	11-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
R	3-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
T	5-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	7-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	9-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	11-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
X	13-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
Y	15-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
Z	17-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AA	21-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AB	23-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AC	25-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AD	27-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AE	29-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AF	1-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AG	5-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AH	7-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AI	9-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AJ	13-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AK	15-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AL	17-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AM	19-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AN	21-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AO	23-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AP	25-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AQ	27-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AR	29-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AS	31-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AT	33-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER MECHANICAL CONNECTION IS REQUIRED.

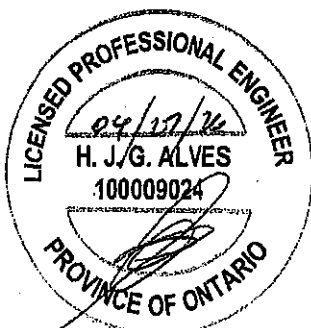


Structural component only
DWG# T-2007017

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408131	T12	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 26 10:07:24 2020 Page 1
ID:DMCubINVR6TstF0e31v6l_zns11-IAQJfzDm6NaHlQpWBbdo0804PwSiap6JFJ2xE3zND0bX

Scale = 1:57.3

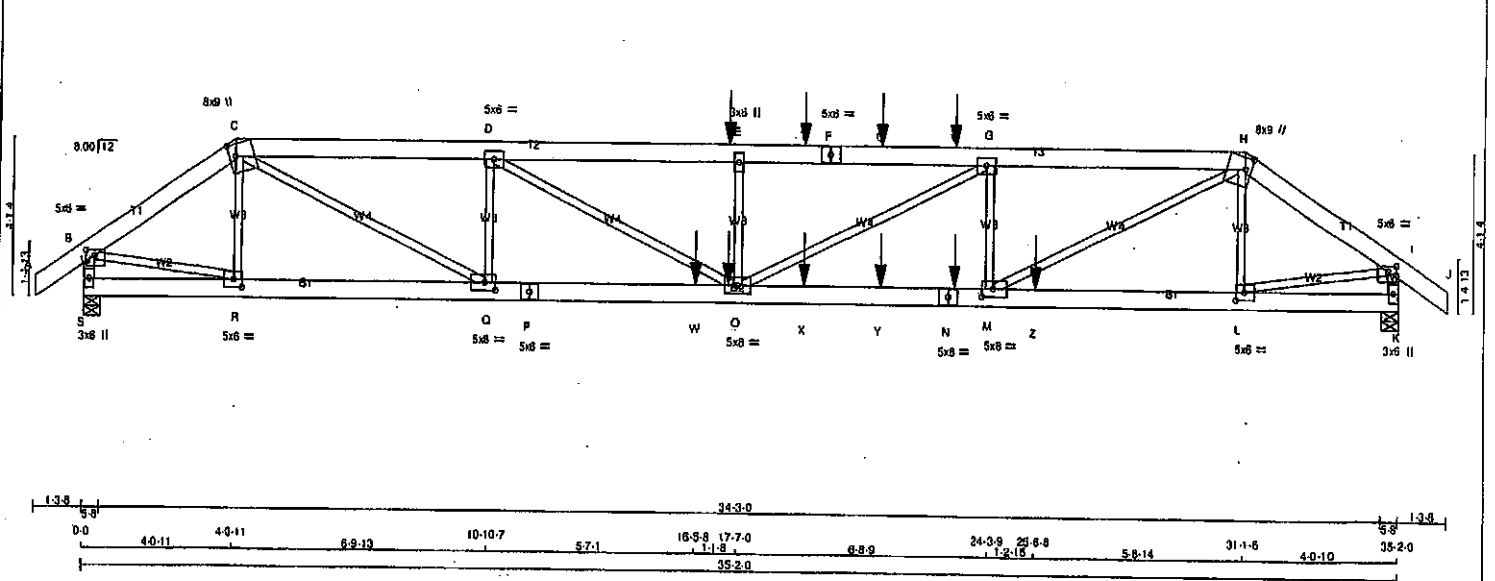

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x6	DRY	No.2	SPF		
C - F	2x8	DRY	No.2	SPF		
F - H	2x8	DRY	No.2	SPF		
H - J	2x8	DRY	No.2	SPF		
J - L	2x4	DRY	No.2	SPF		
L - M	2x4	DRY	No.2	SPF		
M - P	2x6	DRY	No.2	SPF		
P - N	2x6	DRY	No.2	SPF		
N - K	2x6	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 2 12	TOP	SIDE(183.1)
C - F 2 12	TOP	SIDE(0.0)
F - H 2 12	TOP	SIDE(0.0)
H - J 2 12	TOP	SIDE(0.0)
J - L 1 12	TOP	SIDE(0.0)
S - B 1 12	TOP	SIDE(0.0)
K - I 1 12	TOP	SIDE(0.0)
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S - P 2 12	TOP	SIDE(183.1)
P - N 2 12	TOP	SIDE(0.0)
N - K 2 12	TOP	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1 6	TOP	SIDE(0.0)

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	UPLIFT	IN-SX
S	3388	0	0	5-8
K	3900	0	0	5-8

UNFACTORED REACTIONS	1ST LOASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
S	2393	1588/0	0/0
K	2757	1818/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.46 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	CSI (LC)	FR-TO	
A-B	0/36	-91.8	-91.8 0.04 (1)	R-C	-659/0
B-C	-4130/0	-91.8	-91.8 0.09 (1)	C-Q	0/5288
C-D	-8078/0	-91.8	-91.8 0.29 (1)	Q-D	-2102/0
D-E	-10755/0	-91.8	-91.8 0.35 (1)	D-O	0/3048
E-T	-10755/0	-91.8	-91.8 0.44 (1)	O-E	-837/0
F-U	-10755/0	-91.8	-91.8 0.44 (1)	O-G	0/1721
F-U	-10755/0	-91.8	-91.8 0.44 (1)	M-G	-1681/0
U-V	-10755/0	-91.8	-91.8 0.44 (1)	M-H	0/5821
V-G	-10755/0	-91.8	-91.8 0.44 (1)	L-H	-438/0
G-H	-9242/0	-91.8	-91.8 0.33 (1)	B-R	0/3508
H-I	-4958/0	-91.8	-91.8 0.10 (1)	L-I	0/4210
I-J	0/36	-91.8	-91.8 0.04 (1)		
S-B	-3359/0	0.0	0.0 0.19 (1)		
K-I	-3970/0	0.0	0.0 0.22 (1)		
S-R	0/0	-18.5	-18.5 0.03 (4)		
R-Q	0/3408	-18.5	-18.5 0.31 (1)		
Q-P	0/8078	-18.5	-18.5 0.92 (1)		
P-W	0/8078	-18.5	-18.5 0.92 (1)		
W-O	0/8078	-18.5	-18.5 0.92 (1)		
O-X	0/9242	-18.5	-18.5 0.74 (1)		
X-Y	0/9242	-18.5	-18.5 0.74 (1)		
Y-N	0/9242	-18.5	-18.5 0.74 (1)		
N-M	0/9242	-18.5	-18.5 0.74 (1)		
M-Z	0/4102	-18.5	-18.5 0.61 (1)		
Z-L	0/4102	-18.5	-18.5 0.61 (1)		
L-K	0/0	-18.5	-18.5 0.17 (1)		

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	17-4-4	-110	-110	---	---	FRONT	VERT	TOTAL	---	C1
N	23-4-4	-26	-26	---	---	FRONT	VERT	TOTAL	---	C1
O	17-4-4	-26	-26	---	---	FRONT	VERT	TOTAL	---	C1
T	19-4-4	-110	-110	---	---	FRONT	VERT	TOTAL	---	C1
U	21-4-4	-110	-110	---	---	FRONT	VERT	TOTAL	---	C1
V	23-4-4	-110	-110	---	---	FRONT	VERT	TOTAL	---	C1
W	18-5-8	-1480	-1480	---	---	FRONT	VERT	TOTAL	---	C1
X	19-4-4	-26	-26	---	---	FRONT	VERT	TOTAL	---	C1
Y	21-4-4	-26	-26	---	---	FRONT	VERT	TOTAL	---	C1
Z	25-6-8	-1144	-1144	---	---	FRONT	VERT	TOTAL	---	C1

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN.C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")

CALCULATED VERT. DEFL.(LL) = L/989 (0.30")

ALLOWABLE DEFL.(TL) = L/360 (1.17")

CALCULATED VERT. DEFL.(TL) = L/775 (0.54")

CSI: TC=0.44/1.00 (E-G:1), BC=0.92/1.00 (O-Q:1), WB=0.72/1.00 (H-M:1), SS=0.43/1.00 (O-Q:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 618 354 1687 788 1987 1686

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (O) (INPUT = 0.90)

JSI METAL= 0.86 (N) (INPUT = 1.00)

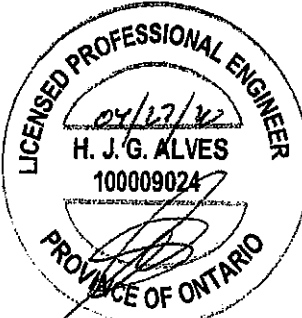

Structural component only
DWG# T-2007018

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408131	T1Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	


Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 10:07:24 2020 Page 2
ID:DMCubINVR6TsFoe31v8l zns1H-AQJfzDm8NaHtOpWBdd0804PwSiao6JFJ2xE3zND6X

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	5.0	6.0	1.75	2.75
C	TTWW+m	MT20	8.0	9.0	3.75	2.00
D	TMWW-l	MT20	5.0	6.0		
E	TMWW-w	MT20	3.0	6.0		
F	TS-l	MT20	5.0	6.0		
G	TMWW-l	MT20	5.0	6.0		
H	TTWW+m	MT20	8.0	9.0	3.75	2.00
I	TMWW-p	MT20	5.0	6.0	1.75	2.75
K	BMV-l-p	MT20	3.0	6.0		
L	BMWW-l	MT20	5.0	6.0	2.50	2.75
M	BMWW-l	MT20	5.0	6.0	2.50	3.50
N	BS-l	MT20	5.0	6.0		
O	BMWWW-l	MT20	5.0	6.0		
P	BS-l	MT20	5.0	6.0		
Q	BMWW-l	MT20	5.0	6.0	2.50	3.50
R	BMWW-l	MT20	5.0	6.0	2.50	2.75
S	BMV-l-p	MT20	3.0	6.0		

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

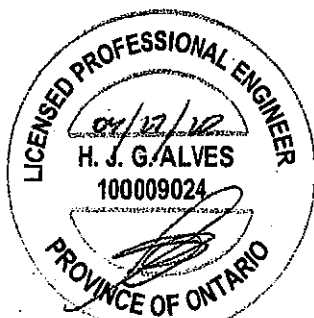

Structural component only
DWG# T-2007018 3/2

JOB NAME 408132	TRUSS NAME T1Z2	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:24:26 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1I-Nn9g8QbqOOLGUUxx3EzGpIk8uFo14TkGJC06qzNDLZ
Scale = 1:57.3

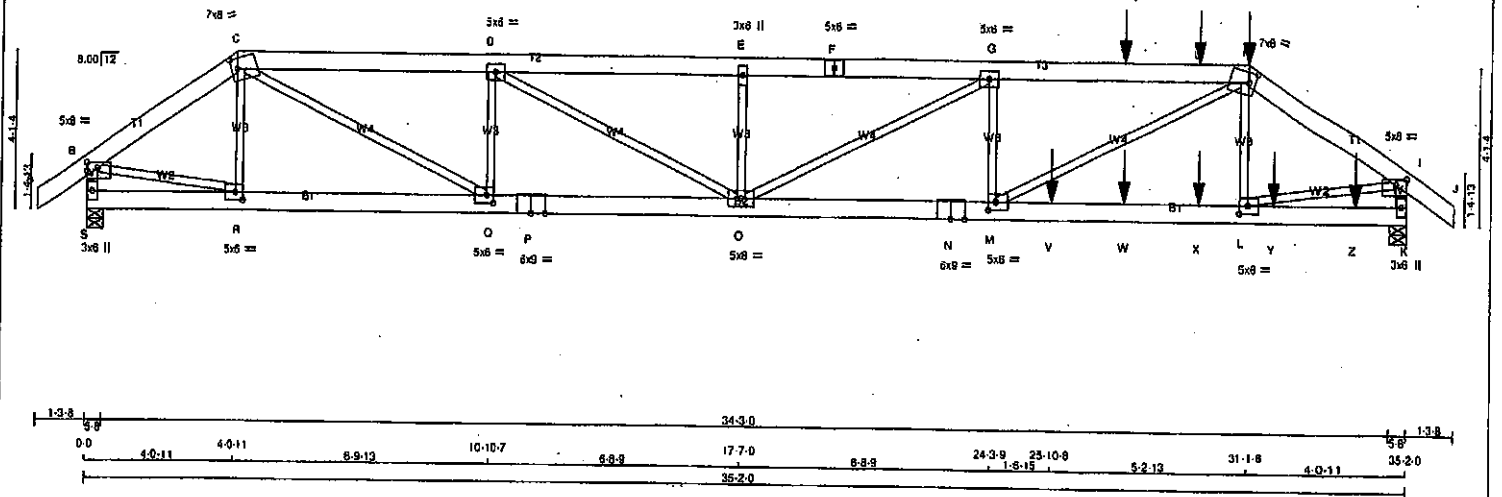

LUMBER			
N.L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x6 DRY	No.2	SPF
C - F	2x6 DRY	No.2	SPF
F - H	2x6 DRY	No.2	SPF
H - J	2x6 DRY	No.2	SPF
S - B	2x4 DRY	No.2	SPF
K - I	2x4 DRY	No.2	SPF
S - P	2x6 DRY	No.2	SPF
P - N	2x6 DRY	No.2	SPF
N - K	2x6 DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C 2	12	TOP
C-F 2	12	TOP
F-H 2	12	SIDE(61.0)
H-J 2	12	SIDE(122.0)
S-B 1	12	TOP
K-I 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S-P 2	12	TOP
P-N 2	12	TOP
N-K 2	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
S	2892	0	2892	0	5-8
K	4101	0	4101	0	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	1900	1271 / 0	0 / 0	0 / 0	0 / 0	629 / 0	0 / 0
K	2893	1938 / 0	0 / 0	0 / 0	0 / 0	955 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.87 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED			WEBS			
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX (PLF)	MAX. UNBRAC CSI (LC)	MEMB.	FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM	TO	LENGTH	FR-TO			
A-B	0 / 36	-91.8	-91.8	0.04 (1)	10.00	R-C	-442 / 0	0.05 (1)
B-C	-3201 / 0	-91.8	-91.8	0.08 (1)	6.10	C-Q	0 / 3750	0.46 (1)
C-D	-5955 / 0	-91.8	-91.8	0.22 (1)	4.89	Q-D	-1803 / 0	0.19 (1)
D-E	-7889 / 0	-91.8	-91.8	0.25 (1)	4.19	D-O	0 / 1951	0.24 (1)
E-F	-7689 / 0	-91.8	-91.8	0.25 (1)	4.20	O-E	-575 / 0	0.07 (1)
F-G	-7689 / 0	-91.8	-91.8	0.25 (1)	4.20	O-G	-915 / 0	0.53 (1)
G-T	-8473 / 0	-91.8	-91.8	0.40 (1)	3.87	M-G	-301 / 2	0.04 (1)
T-U	-8473 / 0	-91.8	-91.8	0.40 (1)	3.87	M-H	0 / 4812	0.57 (1)
U-H	-8473 / 0	-91.8	-91.8	0.40 (1)	3.87	L-H	-128 / 99	0.02 (4)
H-I	-5308 / 0	-91.8	-91.8	0.11 (1)	5.00	B-R	0 / 2717	0.34 (1)
I-J	0 / 36	-91.8	-91.8	0.04 (1)	10.00	L-I	0 / 4503	0.56 (1)
S-B	-2875 / 0	0.0	0.0	0.15 (1)	6.97			
K-I	-4227 / 0	0.0	0.0	0.23 (1)	5.78			

S-R	0 / 0	-18.5	-18.5 0.04 (4)	10.00
R-Q	0 / 2644	-18.5	-18.5 0.20 (1)	10.00
Q-P	0 / 5955	-18.5	-18.5 0.48 (1)	10.00
P-O	0 / 5955	-18.5	-18.5 0.48 (1)	10.00
O-N	0 / 8473	-18.5	-18.5 0.86 (1)	10.00
N-M	0 / 8473	-18.5	-18.5 0.86 (1)	10.00
M-V	0 / 4401	-18.5	-18.5 0.92 (1)	10.00
V-W	0 / 4401	-18.5	-18.5 0.92 (1)	10.00
W-X	0 / 4401	-18.5	-18.5 0.92 (1)	10.00
X-L	0 / 4401	-18.5	-18.5 0.92 (1)	10.00
L-Y	0 / 0	-18.5	-18.5 0.29 (1)	10.00
Y-Z	0 / 0	-18.5	-18.5 0.29 (1)	10.00
Z-K	0 / 0	-18.5	-18.5 0.29 (1)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
H	31-1-8	-49	-55	---	FRONT	VERT	DEAD	C1
H	31-1-8	-254	-254	---	FRONT	VERT	SNOW	C1
T	27-9-12	-110	-110	---	FRONT	VERT	TOTAL	C1
U	29-9-12	-110	-110	---	FRONT	VERT	TOTAL	C1
V	25-10-8	-2027	-2027	---	FRONT	VERT	TOTAL	C1
W	27-9-12	-28	-28	---	FRONT	VERT	TOTAL	C1
X	29-9-12	-28	-28	---	FRONT	VERT	TOTAL	C1
Y	31-9-12	-28	-28	---	FRONT	VERT	TOTAL	C1
Z	33-9-12	-28	-28	---	FRONT	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

TOTAL WEIGHT = 2 X 180 = 360 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL	= 25.8	PSF
DL	= 6.0	PSF
BOT CH. LL	= 0.0	PSF
DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL. USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.22")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.40")

CSI: TC=0.40/1.00 (G-H:1), BC=0.92/1.00 (L-M:1),
WB=0.57/1.00 (H-M:1), SSI=0.54/1.00 (L-M:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (C) INPUT = 0.90
JSI METAL = 0.81 (P) INPUT = 1.00

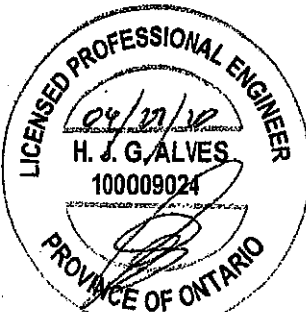

Structural component only
DWG# T-2007029 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408132	T1Z2	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 10:24:26 2020 Page 2
ID:DMCubINVR6TstFoe31v6l zns1l-Nn9q9QbqCOLGUUxx3EzGpfLk8uFo14TKGJc08qzNDLZ

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.75	3.50
C	TTWW-m	MT20	7.0	8.0	3.25	2.00
D	TMVW-t	MT20	5.0	8.0		
E	TMVW-w	MT20	3.0	8.0		
F	TS-l	MT20	5.0	8.0		
G	TMVW-t	MT20	5.0	8.0		
H	TTWW-m	MT20	7.0	8.0	3.25	2.00
I	TMVW-p	MT20	5.0	8.0	1.75	3.50
K	BMV1-p	MT20	3.0	8.0		
L	BMVW-l	MT20	5.0	8.0	2.50	2.50
M	BMVW-l	MT20	5.0	8.0	2.50	2.25
N	BS-l	MT20	6.0	8.0		
O	BMVW-l	MT20	5.0	8.0		
P	BS-l	MT20	6.0	8.0		
Q	BMVW-l	MT20	5.0	8.0	2.50	2.25
R	BMVW-l	MT20	5.0	8.0	2.50	2.50
S	BMV1-p	MT20	3.0	8.0		

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007029 7/2

Structural component only
DWG# T-2006954

Structural component only
DWG# T-2006955

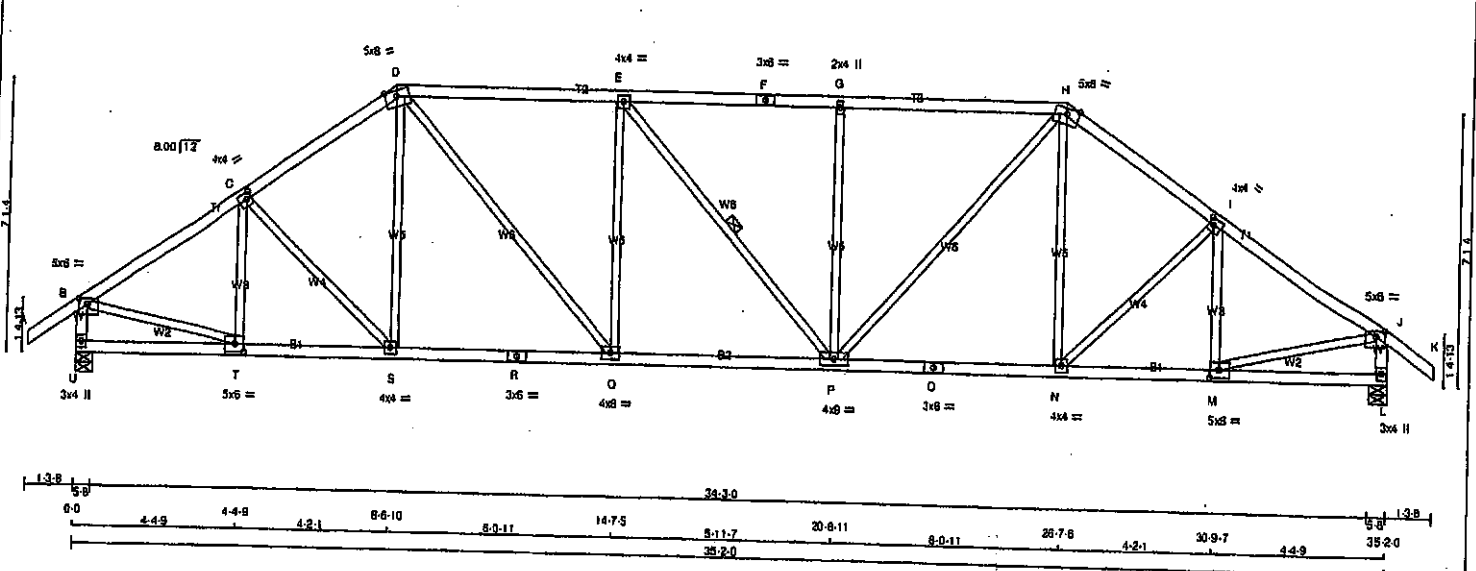

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - K	2x4	DRY	No.2	SPF
U - B	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
U - R	2x4	DRY	No.2	SPF
R - O	2x4	DRY	No.2	SPF
O - L	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMWW-p	MT20	5.0	8.0	1.75	2.75
C TMWW-l	MT20	4.0	4.0	2.00	1.50
D TTWW-m	MT20	5.0	8.0	Edge	
E TMWW-l	MT20	4.0	4.0		
F TS-l	MT20	3.0	8.0		
G TMWW-w	MT20	2.0	4.0		
H TTWW-m	MT20	5.0	8.0	Edge	
I TMWW-l	MT20	4.0	4.0	2.00	1.50
J TMWW-p	MT20	5.0	8.0	1.75	2.75
L BMV-l-p	MT20	3.0	4.0		
M BMWW-l	MT20	5.0	8.0	2.50	2.75
N BMWW-l	MT20	4.0	4.0		
O BS-l	MT20	3.0	8.0		
P BMWW-l	MT20	4.0	8.0		
Q BMWW-l	MT20	4.0	8.0		
R BS-l	MT20	3.0	8.0		
S BMWW-l	MT20	4.0	4.0		
T BMWW-l	MT20	5.0	8.0	2.50	2.75
U BMV-l-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION VERT	FACTORED GROSS REACTION DOWN	FACTORED GROSS REACTION UPLIFT	INPUT BRG IN-SX	REQD BRG IN-SX
U	2065	0	0	5-8	5-8
L	2065	0	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE COMBINED SNOW	MAX. MIN. COMPONENT REACTIONS LIVE	PERM. LIVE WIND	DEAD	SOIL
U	1458	970 / 0	0 / 0	0 / 0	488 / 0
L	1458	970 / 0	0 / 0	0 / 0	488 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO					FR-TO		
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	T-C	-396 / 0
B-C	-2270 / 0	-91.8	-91.8	0.37 (1)	4.19	C-S	-79 / 0
C-D	-2254 / 0	-91.8	-91.8	0.38 (1)	4.21	S-D	0 / 156
D-E	-2485 / 0	-91.8	-91.8	0.84 (1)	3.72	D-Q	0 / 949
E-F	-2484 / 0	-91.8	-91.8	0.84 (1)	3.72	Q-E	-597 / 0
F-G	-2484 / 0	-91.8	-91.8	0.84 (1)	3.74	P-G	-597 / 0
G-H	-2484 / 0	-91.8	-91.8	0.83 (1)	4.21	P-H	-2 / 0
H-I	-2254 / 0	-91.8	-91.8	0.36 (1)	4.19	N-H	0 / 157
I-J	-2270 / 0	-91.8	-91.8	0.37 (1)	10.00	N-I	-78 / 0
J-K	0 / 35	-91.8	-91.8	0.12 (1)	5.94	M-I	-397 / 0
U-B	-2027 / 0	0.0	0.0	0.21 (1)	5.94	B-T	0 / 1966
L-J	-2026 / 0	0.0	0.0	0.21 (1)	5.94	M-J	0 / 1966
U-T	0 / 0	-18.5	-18.5	0.08 (4)	10.00		
T-S	0 / 1909	-18.5	-18.5	0.37 (1)	10.00		
S-R	0 / 1854	-18.5	-18.5	0.38 (1)	10.00		
R-Q	0 / 1854	-18.5	-18.5	0.38 (1)	10.00		
Q-P	0 / 2485	-18.5	-18.5	0.47 (1)	10.00		
P-O	0 / 1854	-18.5	-18.5	0.36 (1)	10.00		
O-N	0 / 1854	-18.5	-18.5	0.38 (1)	10.00		
N-M	0 / 1909	-18.5	-18.5	0.37 (1)	10.00		
M-L	0 / 0	-18.5	-18.5	0.08 (4)	10.00		

TOTAL WEIGHT = 2 X 155 = 309 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBCC 2010, OBC 2012, ABC 2010
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
 CALCULATED VERT. DEFL. (LL) = L/999 (0.12")
 ALLOWABLE DEFL. (TL) = L/360 (1.17")
 CALCULATED VERT. DEFL. (TL) = L/999 (0.24")

CSI: TC=0.84/1.00 (D-E:1), BC=0.47/1.00 (P-Q:1), WB=0.52/1.00 (E-Q:1), SSI=0.20/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	518 334	1887 786

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (I) (INPUT = 0.90)
 JSI METAL = 0.82 (I) (INPUT = 1.00)





DESCR
SPF
SPF
SPF
SPF
SPF
SPF
SPF

SPF
SPF
SPF

BEARINGS

1998, 1999, 2000, 2001, 2002, 2003, 2004, 2005, 2006, 2007, 2008, 2009, 2010, 2011, 2012, 2013, 2014, 2015, 2016, 2017, 2018, 2019, 2020, 2021, 2022, 2023, 2024, 2025, 2026, 2027, 2028, 2029, 2030, 2031, 2032, 2033, 2034, 2035, 2036, 2037, 2038, 2039, 2040, 2041, 2042, 2043, 2044, 2045, 2046, 2047, 2048, 2049, 2050, 2051, 2052, 2053, 2054, 2055, 2056, 2057, 2058, 2059, 2060, 2061, 2062, 2063, 2064, 2065, 2066, 2067, 2068, 2069, 2070, 2071, 2072, 2073, 2074, 2075, 2076, 2077, 2078, 2079, 2080, 2081, 2082, 2083, 2084, 2085, 2086, 2087, 2088, 2089, 2090, 2091, 2092, 2093, 2094, 2095, 2096, 2097, 2098, 2099, 2100, 2101, 2102, 2103, 2104, 2105, 2106, 2107, 2108, 2109, 2110, 2111, 2112, 2113, 2114, 2115, 2116, 2117, 2118, 2119, 2120, 2121, 2122, 2123, 2124, 2125, 2126, 2127, 2128, 2129, 2130, 2131, 2132, 2133, 2134, 2135, 2136, 2137, 2138, 2139, 2140, 2141, 2142, 2143, 2144, 2145, 2146, 2147, 2148, 2149, 2150, 2151, 2152, 2153, 2154, 2155, 2156, 2157, 2158, 2159, 2160, 2161, 2162, 2163, 2164, 2165, 2166, 2167, 2168, 2169, 2170, 2171, 2172, 2173, 2174, 2175, 2176, 2177, 2178, 2179, 2180, 2181, 2182, 2183, 2184, 2185, 2186, 2187, 2188, 2189, 2190, 2191, 2192, 2193, 2194, 2195, 2196, 2197, 2198, 2199, 2200, 2201, 2202, 2203, 2204, 2205, 2206, 2207, 2208, 2209, 2210, 2211, 2212, 2213, 2214, 2215, 2216, 2217, 2218, 2219, 2220, 2221, 2222, 2223, 2224, 2225, 2226, 2227, 2228, 2229, 2230, 2231, 2232, 2233, 2234, 2235, 2236, 2237, 2238, 2239, 2240, 2241, 2242, 2243, 2244, 2245, 2246, 2247, 2248, 2249, 2250, 2251, 2252, 2253, 2254, 2255, 2256, 2257, 2258, 2259, 2260, 2261, 2262, 2263, 2264, 2265, 2266, 2267, 2268, 2269, 2270, 2271, 2272, 2273, 2274, 2275, 2276, 2277, 2278, 2279, 2280, 2281, 2282, 2283, 2284, 2285, 2286, 2287, 2288, 2289, 2290, 2291, 2292, 2293, 2294, 2295, 2296, 2297, 2298, 2299, 2300, 2301, 2302, 2303, 2304, 2305, 2306, 2307, 2308, 2309, 2310, 2311, 2312, 2313, 2314, 2315, 2316, 2317, 2318, 2319, 2320, 2321, 2322, 2323, 2324, 2325, 2326, 2327, 2328, 2329, 2330, 2331, 2332, 2333, 2334, 2335, 2336, 2337, 2338, 2339, 2340, 2341, 2342, 2343, 2344, 2345, 2346, 2347, 2348, 2349, 2350, 2351, 2352, 2353, 2354, 2355, 2356, 2357, 2358, 2359, 2360, 2361, 2362, 2363, 2364, 2365, 2366, 2367, 2368, 2369, 2370, 2371, 2372, 2373, 2374, 2375, 2376, 2377, 2378, 2379, 2380, 2381, 2382, 2383, 2384, 2385, 2386, 2387, 2388, 2389, 2390, 2391, 2392, 2393, 2394, 2395, 2396, 2397, 2398, 2399, 2400, 2401, 2402, 2403, 2404, 2405, 2406, 2407, 2408, 2409, 2410, 2411, 2412, 2413, 2414, 2415, 2416, 2417, 2418, 2419, 2420, 2421, 2422, 2423, 2424, 2425, 2426, 2427, 2428, 2429, 2430, 2431, 2432, 2433, 2434, 2435, 2436, 2437, 2438, 2439, 2440, 2441, 2442, 2443, 2444, 2445, 2446, 2447, 2448, 2449, 2450, 2451, 2452, 2453, 2454, 2455, 2456, 2457, 2458, 2459, 2460, 2461, 2462, 2463, 2464, 2465, 2466, 2467, 2468, 2469, 2470, 2471, 2472, 2473, 2474, 2475, 2476, 2477, 2478, 2479, 2480, 2481, 2482, 2483, 2484, 2485, 2486, 2487, 2488, 2489, 2490, 2491, 2492, 2493, 2494, 2495, 2496, 2497, 2498, 2499, 2500, 2501, 2502, 2503, 2504, 2505, 2506, 2507, 2508, 2509, 2510, 2511, 2512, 2513, 2514, 2515, 2516, 2517, 2518, 2519, 2520, 2521, 2522, 2523, 2524, 2525, 2526, 2527, 2528, 2529, 2530, 2531, 2532, 2533, 2534, 2535, 2536, 2537, 2538, 2539, 2540, 2541, 2542, 2543, 2544, 2545, 2546, 2547, 2548, 2549, 2550, 2551, 2552, 2553, 2554, 2555, 2556, 2557, 2558, 2559, 2560, 2561, 2562, 2563, 2564, 2565, 2566, 2567, 2568, 2569, 2570, 2571, 2572, 2573, 2574, 2575, 2576, 2577, 2578, 2579, 2580, 2581, 2582, 2583, 2584, 2585, 2586, 2587, 2588, 2589, 2590, 2591, 2592, 2593, 2594, 2595, 2596, 2597, 2598, 2599, 2600, 2601, 2602, 2603, 2604, 2605, 2606, 2607, 2608, 2609, 2610, 2611, 2612, 2613, 2614, 2615, 2616, 2617, 2618, 2619, 2620, 2621, 2622, 2623, 2624, 2625, 2626, 2627, 2628, 2629, 2630, 2631, 2632, 2633, 2634, 2635, 2636, 2637, 2638, 2639, 2640, 2641, 2642, 2643, 2644, 2645, 2646, 2647, 2648, 2649, 2650, 2651, 2652, 2653, 2654, 2655, 2656, 2657, 2658, 2659, 2660, 2661, 2662, 2663, 2664, 2665, 2666, 2667, 2668, 2669, 2670, 2671, 2672, 2673, 2674, 2675, 2676, 2677, 2678, 2679, 26

BEARING MATERIAL TO

BRACING

TOP CHORD TO BE SH

ALL PITCH BREAKS AND

1 LATERAL BRACE(S) /

END VERTICAL (S) MUIS

LOADING

TOTAL LOAD CASES: {4

CHORDS

(M)F

1998, 1999, 2000, 2001, 2002, 2003, 2004, 2005, 2006, 2007, 2008, 2009, 2010, 2011, 2012, 2013, 2014, 2015, 2016, 2017, 2018, 2019, 2020, 2021, 2022, 2023, 2024, 2025, 2026, 2027, 2028, 2029, 2030, 2031, 2032, 2033, 2034, 2035, 2036, 2037, 2038, 2039, 2040, 2041, 2042, 2043, 2044, 2045, 2046, 2047, 2048, 2049, 2050, 2051, 2052, 2053, 2054, 2055, 2056, 2057, 2058, 2059, 2060, 2061, 2062, 2063, 2064, 2065, 2066, 2067, 2068, 2069, 2070, 2071, 2072, 2073, 2074, 2075, 2076, 2077, 2078, 2079, 2080, 2081, 2082, 2083, 2084, 2085, 2086, 2087, 2088, 2089, 2090, 2091, 2092, 2093, 2094, 2095, 2096, 2097, 2098, 2099, 2100, 2101, 2102, 2103, 2104, 2105, 2106, 2107, 2108, 2109, 2110, 2111, 2112, 2113, 2114, 2115, 2116, 2117, 2118, 2119, 2120, 2121, 2122, 2123, 2124, 2125, 2126, 2127, 2128, 2129, 2130, 2131, 2132, 2133, 2134, 2135, 2136, 2137, 2138, 2139, 2140, 2141, 2142, 2143, 2144, 2145, 2146, 2147, 2148, 2149, 2150, 2151, 2152, 2153, 2154, 2155, 2156, 2157, 2158, 2159, 2160, 2161, 2162, 2163, 2164, 2165, 2166, 2167, 2168, 2169, 2170, 2171, 2172, 2173, 2174, 2175, 2176, 2177, 2178, 2179, 2180, 2181, 2182, 2183, 2184, 2185, 2186, 2187, 2188, 2189, 2190, 2191, 2192, 2193, 2194, 2195, 2196, 2197, 2198, 2199, 2200, 2201, 2202, 2203, 2204, 2205, 2206, 2207, 2208, 2209, 2210, 2211, 2212, 2213, 2214, 2215, 2216, 2217, 2218, 2219, 2220, 2221, 2222, 2223, 2224, 2225, 2226, 2227, 2228, 2229, 2230, 2231, 2232, 2233, 2234, 2235, 2236, 2237, 2238, 2239, 2240, 2241, 2242, 2243, 2244, 2245, 2246, 2247, 2248, 2249, 2250, 2251, 2252, 2253, 2254, 2255, 2256, 2257, 2258, 2259, 2260, 2261, 2262, 2263, 2264, 2265, 2266, 2267, 2268, 2269, 2270, 2271, 2272, 2273, 2274, 2275, 2276, 2277, 2278, 2279, 2280, 2281, 2282, 2283, 2284, 2285, 2286, 2287, 2288, 2289, 2290, 2291, 2292, 2293, 2294, 2295, 2296, 2297, 2298, 2299, 2300, 2301, 2302, 2303, 2304, 2305, 2306, 2307, 2308, 2309, 2310, 2311, 2312, 2313, 2314, 2315, 2316, 2317, 2318, 2319, 2320, 2321, 2322, 2323, 2324, 2325, 2326, 2327, 2328, 2329, 2330, 2331, 2332, 2333, 2334, 2335, 2336, 2337, 2338, 2339, 2340, 2341, 2342, 2343, 2344, 2345, 2346, 2347, 2348, 2349, 2350, 2351, 2352, 2353, 2354, 2355, 2356, 2357, 2358, 2359, 2360, 2361, 2362, 2363, 2364, 2365, 2366, 2367, 2368, 2369, 2370, 2371, 2372, 2373, 2374, 2375, 2376, 2377, 2378, 2379, 2380, 2381, 2382, 2383, 2384, 2385, 2386, 2387, 2388, 2389, 2390, 2391, 2392, 2393, 2394, 2395, 2396, 2397, 2398, 2399, 2400, 2401, 2402, 2403, 2404, 2405, 2406, 2407, 2408, 2409, 2410, 2411, 2412, 2413, 2414, 2415, 2416, 2417, 2418, 2419, 2420, 2421, 2422, 2423, 2424, 2425, 2426, 2427, 2428, 2429, 2430, 2431, 2432, 2433, 2434, 2435, 2436, 2437, 2438, 2439, 2440, 2441, 2442, 2443, 2444, 2445, 2446, 2447, 2448, 2449, 2450, 2451, 2452, 2453, 2454, 2455, 2456, 2457, 2458, 2459, 2460, 2461, 2462, 2463, 2464, 2465, 2466, 2467, 2468, 2469, 2470, 2471, 2472, 2473, 2474, 2475, 2476, 2477, 2478, 2479, 2480, 2481, 2482, 2483, 2484, 2485, 2486, 2487, 2488, 2489, 2490, 2491, 2492, 2493, 2494, 2495, 2496, 2497, 2498, 2499, 2500, 2501, 2502, 2503, 2504, 2505, 2506, 2507, 2508, 2509, 2510, 2511, 2512, 2513, 2514, 2515, 2516, 2517, 2518, 2519, 2520, 2521, 2522, 2523, 2524, 2525, 2526, 2527, 2528, 2529, 2530, 2531, 2532, 2533, 2534, 2535, 2536, 2537, 2538, 2539, 2540, 2541, 2542, 2543, 2544, 2545, 2546, 2547, 2548, 2549, 2550, 2551, 2552, 2553, 2554, 2555, 2556, 2557, 2558, 2559, 2560, 2561, 2562, 2563, 2564, 2565, 2566, 2567, 2568, 2569, 2570, 2571, 2572, 2573, 2574, 2575, 2576, 2577, 2578, 2579, 2580, 2581, 2582, 2583, 2584, 2585, 2586, 2587, 2588, 2589, 2590, 2591, 2592, 2593, 2594, 2595, 2596, 2597, 2598, 2599, 2600, 2601, 2602, 2603, 2604, 2605, 2606, 2607, 2608, 2609, 2610, 2611, 2612, 2613, 2614, 2615, 2616, 2617, 2618, 2619, 2620, 2621, 2622, 2623, 2624, 2625, 2626, 2627, 2628, 2629, 2630, 2631, 2632, 2633, 2634, 2635, 2636, 2637, 2638, 2639, 2640, 2641, 2642, 2643, 2644, 2645, 2646, 2647, 2648, 2649, 2650, 2651, 2652, 2653, 2654, 2655, 2656, 2657, 2658, 2659, 2660, 2661, 2662, 2663, 2664, 2665, 2666, 2667, 2668, 2669, 2670, 2671, 2672, 2673, 2674, 2675, 2676, 2677, 2678, 2679, 26

TOP	CH.	CL	DL
-----	-----	----	----

BOT CH. LL =
DI =

TOTAL LOAD =

SPACING 24

THIS TABLE IS DE

THIS DESIGN ROOM

- CSA 086-09, CSA

(53 % OF 31.3 P.S.F.)

ALLOWABLE DEF

CSI: TC=0.81/1.00 {C

COMP=1.10 SHEAR

CROSS MANUFACTURING


(PSI)

LATE PLACEMENT

SI GRIP= 0.87 (B) (IN



JOB NAME: 408087 TRUSS NAME: T6 QUANTITY: 2 PLV: 1 JOB DESC.: GREEN PARK HOMES TRUSS DESC.: DWG NO.:
 Version 8.310 S Oct 29 2019 MITEX Industries, Inc. Sat Apr 25 08:53:19 2020 Page 1
 ID:DMCubINVR8TstFoe31v6l_zns11-y1Jw4RavYz5KVEIZOEknQRISV7cXi27GoDkCzNEh
 Scale = 1:57.3

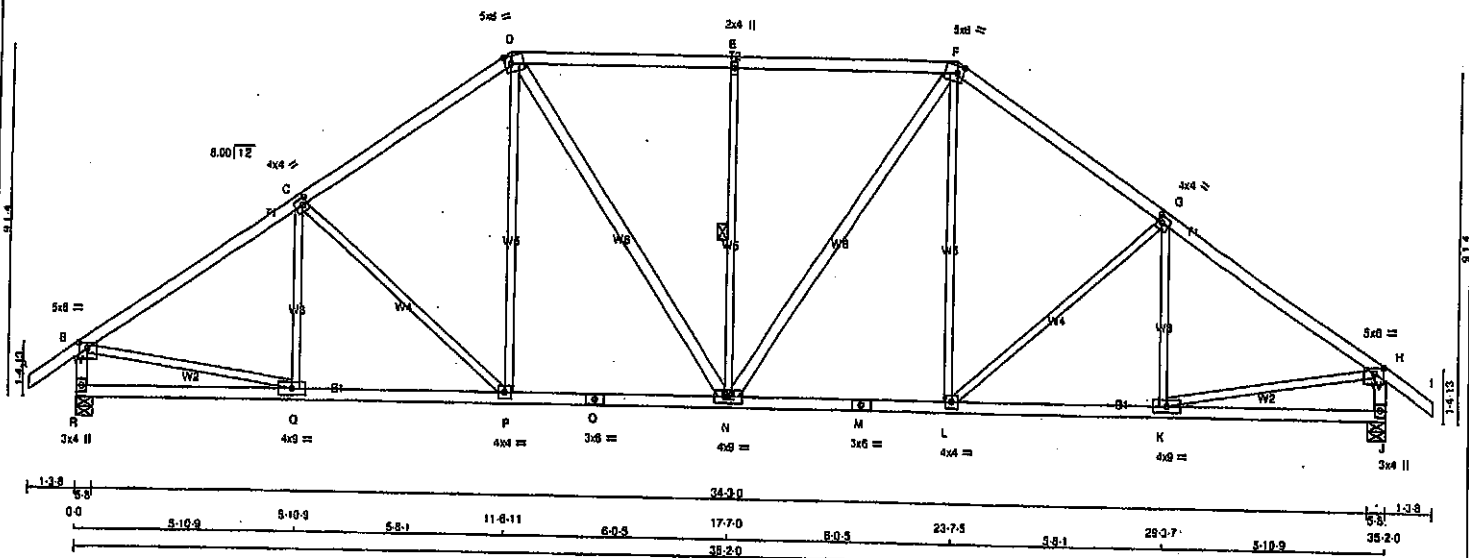

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	NO.2
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY; SEASONED LUMBER.

DESIGNER
BUILDING DESIGNER

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	2065	0	0
R	2065	0	0
J	2065	0	0

UNFACTORED REACTIONS

1ST LOOSE	MAX/MIN COMPONENT REACTIONS	DEAD	SOIL
JT	1458	970 / 0	0 / 0
R	1458	970 / 0	0 / 0
J	1458	970 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J
BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.99 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.
 1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.
 END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO	0 / 35	-91.8	-91.8	0.12 (1)	10.00	0 / 35	-91.8	-91.8	0.12 (1)
A-B	-2347 / 0	-91.8	-91.8	0.52 (1)	3.99	C-P	-358 / 0	-91.8	0.42 (1)
B-C	-2098 / 0	-91.8	-91.8	0.48 (1)	4.22	P-D	0 / 342	-91.8	0.08 (1)
C-D	-1985 / 0	-91.8	-91.8	0.49 (1)	4.26	D-N	0 / 477	-91.8	0.08 (1)
D-E	-1985 / 0	-91.8	-91.8	0.49 (1)	4.26	N-E	-677 / 0	-91.8	0.37 (1)
E-F	-2098 / 0	-91.8	-91.8	0.48 (1)	4.22	N-F	0 / 477	-91.8	0.08 (1)
F-G	-2347 / 0	-91.8	-91.8	0.52 (1)	3.99	L-F	0 / 342	-91.8	0.08 (1)
G-H	0 / 35	-91.8	-91.8	0.12 (1)	10.00	L-G	-358 / 0	-91.8	0.42 (1)
H-I	-2018 / 0	0.0	0.0	0.21 (1)	5.94	K-G	-248 / 11	-91.8	0.11 (1)
I-J	-2018 / 0	0.0	0.0	0.21 (1)	5.94	B-Q	0 / 2014	-91.8	0.45 (1)
R-O	0 / 0	-18.5	-18.5	0.14 (4)	10.00	K-H	0 / 2014	-91.8	0.45 (1)
O-P	0 / 1981	-18.5	-18.5	0.39 (1)	10.00				
P-O	0 / 1716	-18.5	-18.5	0.34 (1)	10.00				
O-N	0 / 1716	-18.5	-18.5	0.34 (1)	10.00				
N-M	0 / 1716	-18.5	-18.5	0.34 (1)	10.00				
M-L	0 / 1716	-18.5	-18.5	0.34 (1)	10.00				
L-K	0 / 1981	-18.5	-18.5	0.39 (1)	10.00				
K-J	0 / 0	-18.5	-18.5	0.14 (4)	10.00				

TOTAL WEIGHT = 2 X 165 = 329 LB

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.19")

CSI: TC=0.52/1.00 (B-C:1), BC=0.39/1.00 (K-L:1), WB=0.45/1.00 (H-K:1), SS=0.27/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1687 788 1987 1658


PLATE PLACEMENT TOL. = 0.280 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (B) (INPUT = 0.90)
 JSI METAL = 0.58 (M) (INPUT = 1.00)



Structural component only

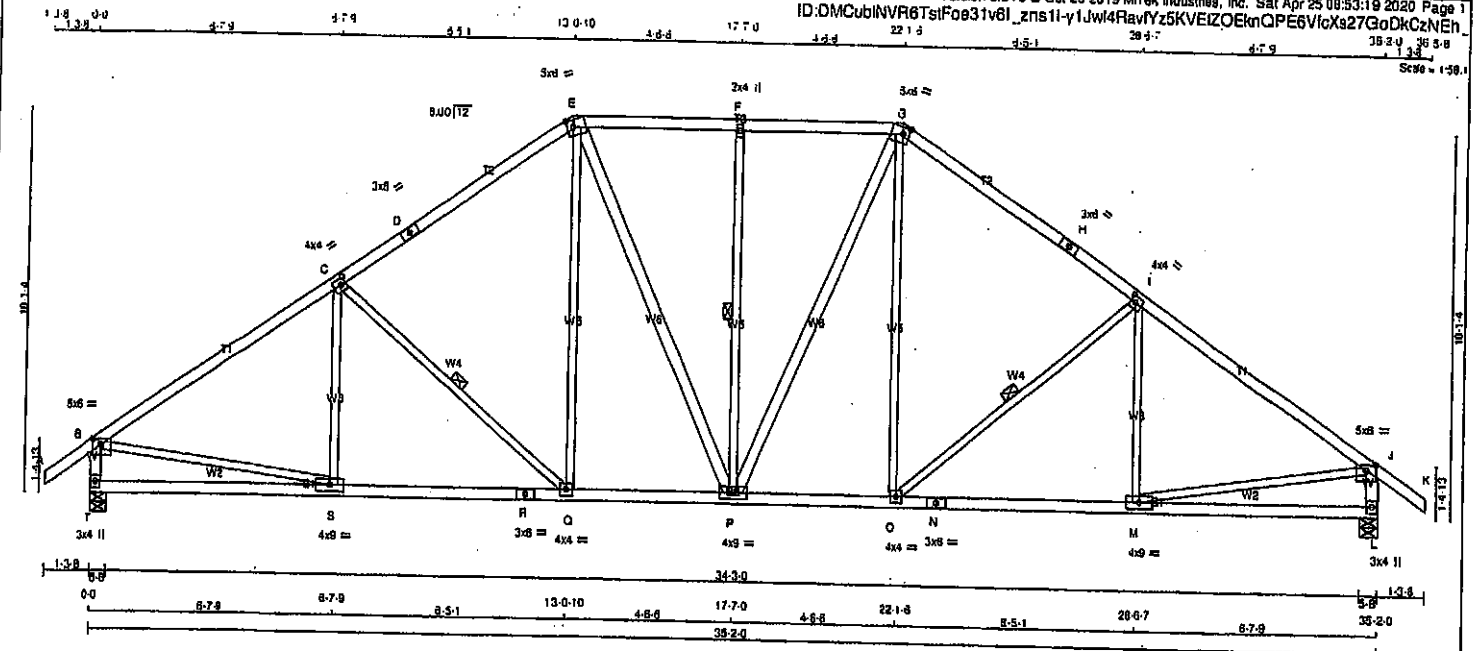

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
T - B	2x4	DRY	No.2
T - J	2x4	DRY	No.2
R - R	2x4	DRY	No.2
R - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS EXCEPT E - P	2x3	DRY	No.2
P - G	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.75	2.75
C	TMVW-l	MT20	4.0	4.0	2.00	1.50
D	TS-l	MT20	3.0	8.0		
E	TTVW-m	MT20	5.0	8.0	2.25	2.00
F	TMVW-w	MT20	2.0	4.0		
G	TTVW-m	MT20	5.0	8.0	2.25	2.00
H	TS-l	MT20	3.0	8.0		
I	TMVW-l	MT20	4.0	4.0	2.00	1.50
J	TMVW-p	MT20	5.0	8.0	1.75	2.75
L	BMV1-p	MT20	3.0	4.0		
M	BMVW-l	MT20	4.0	9.0		
N	BS-l	MT20	3.0	8.0		
O	BMVW-l	MT20	4.0	9.0		
P	BMVW-l	MT20	4.0	9.0		
Q	BMVW-l	MT20	4.0	9.0		
R	BS-l	MT20	3.0	8.0		
S	BMVW-l	MT20	4.0	9.0		
T	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECORD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
T	2085	0	2085	0	5-8	5-8
L	2085	0	2085	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
T	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.03 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-Q, F-P, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS		FACTORED	
	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1	MAX (PLF)	MAX. UNBRAC LENGTH	MEMB. FORCE (LBS)	MAX. UNBRAC LENGTH	MEMB. FORCE (LBS)	MAX. UNBRAC LENGTH
FR-TO								
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	S-C	-189 / 46	0.10 (1)
B-C	-2359 / 0	-91.8	-91.8	0.89 (1)	3.77	C-Q	-485 / 0	0.24 (1)
C-D	-1986 / 0	-91.8	-91.8	0.82 (1)	4.11	Q-E	0 / 416	0.09 (1)
D-E	-1986 / 0	-91.8	-91.8	0.82 (1)	4.11	E-P	0 / 315	0.05 (1)
E-F	-1762 / 0	-91.8	-91.8	0.27 (1)	4.77	P-F	-502 / 0	0.35 (1)
F-G	-1762 / 0	-91.8	-91.8	0.27 (1)	4.77	P-G	0 / 315	0.05 (1)
G-H	-1995 / 0	-91.8	-91.8	0.82 (1)	4.11	O-G	0 / 416	0.09 (1)
H-I	-1995 / 0	-91.8	-91.8	0.82 (1)	4.11	O-I	-485 / 0	0.24 (1)
I-J	-2359 / 0	-91.8	-91.8	0.89 (1)	3.77	M-I	-189 / 46	0.10 (1)
J-K	0 / 35	-91.8	-91.8	0.12 (1)	10.00	B-S	0 / 2022	0.45 (1)
T-B	-2014 / 0	0.0	0.0	0.21 (1)	5.95	M-J	0 / 2022	0.45 (1)
L-J	-2014 / 0	0.0	0.0	0.21 (1)	5.95			
T-S	0 / 0	-18.5	-18.5	0.19 (4)	10.00			
S-R	0 / 1986	-18.5	-18.5	0.42 (1)	10.00			
R-Q	0 / 1986	-18.5	-18.5	0.42 (1)	10.00			
Q-P	0 / 1630	-18.5	-18.5	0.32 (1)	10.00			
P-O	0 / 1630	-18.5	-18.5	0.32 (1)	10.00			
O-N	0 / 1986	-18.5	-18.5	0.42 (1)	10.00			
N-M	0 / 1986	-18.5	-18.5	0.42 (1)	10.00			
M-L	0 / 0	-18.5	-18.5	0.19 (4)	10.00			

TOTAL WEIGHT = 3 X 172 = 515 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CSI: TC=0.89/1.00 (I-J:1), BC=0.42/1.00 (M-O:1), WB=0.45/1.00 (J-M:1), SS=0.24/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.87 (B) (INPUT = 0.80)
JSI METAL = 0.58 (N) (INPUT = 1.00)

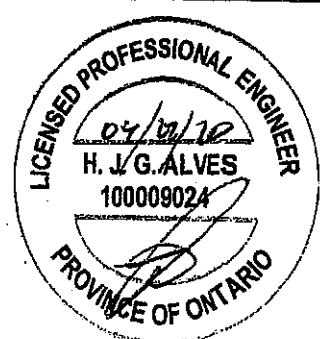

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 10:07:25 2020 Page 1
ID:DMCubINVR6TstFoe3Iv6I_znsfI-mMyhtJE0thi8UaOjH8qwmZ83KwJKWSUznUmVzNDbW

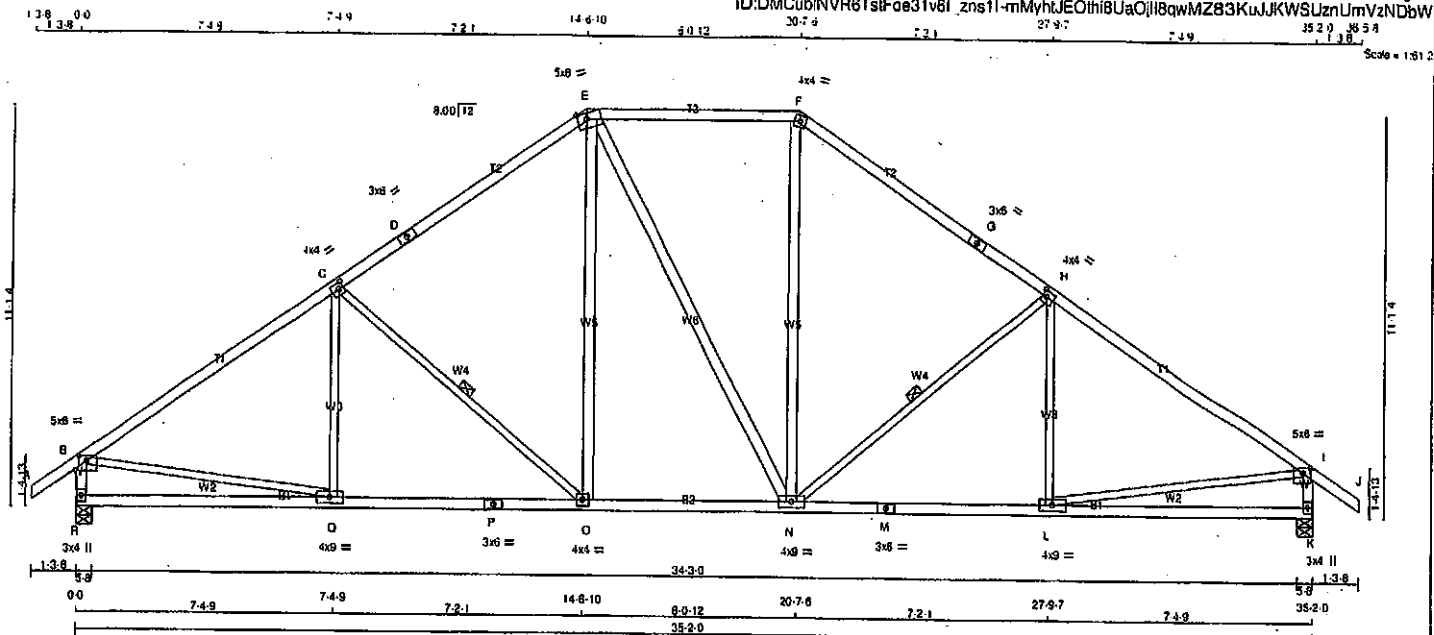

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
G - J	2x4	DRY	No.2	SPF
J - B	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
R - P	2x4	DRY	No.2	SPF
P - M	2x4	DRY	No.2	SPF
M - K	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
O - E	2x4	DRY	No.2	SPF
E - N	2x4	DRY	No.2	SPF
N - F	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TS-t	MT20	3.0	6.0		
E	TTWW-m	MT20	5.0	8.0	2.00	3.00
F	TTW-m	MT20	4.0	4.0		
G	TS-t	MT20	3.0	6.0		
H	TMVW-t	MT20	4.0	4.0	2.00	1.50
I	TMVW-p	MT20	5.0	6.0	1.75	2.75
K	BMV1-p	MT20	3.0	4.0		
L	BMVW-t	MT20	4.0	9.0		
M	BS-t	MT20	3.0	6.0		
N	BMVWW-t	MT20	4.0	9.0		
O	BMVW-t	MT20	4.0	4.0		
P	BS-t	MT20	3.0	6.0		
Q	BMVW-t	MT20	4.0	9.0		
R	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	2065	0	5-8
R	2065	0	5-8
K	2065	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX./MIN. COMPONENT REACTIONS	DEAD	SOIL
JT COMBINED	1458	970 / 0	0 / 0
R	1458	970 / 0	0 / 0
K	1458	970 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.45 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	FACTORED		MAX. UNBRACED LENGTH	WEBS MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
			FROM	TO			
FR-TO							
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	Q-C	-139 / 76
B-C	-2358 / 0	-91.8	-91.8	0.89 (1)	3.45	C-O	-605 / 0
C-D	-1888 / 0	-91.8	-91.8	0.78 (1)	3.91	O-E	0 / 499
D-E	-1888 / 0	-91.8	-91.8	0.78 (1)	3.91	E-N	0 / 0
E-F	-1538 / 0	-91.8	-91.8	0.47 (1)	4.74	N-F	0 / 500
F-G	-1888 / 0	-91.8	-91.8	0.78 (1)	3.91	N-H	-604 / 0
G-H	-1888 / 0	-91.8	-91.8	0.78 (1)	3.91	L-H	-140 / 75
H-I	-2357 / 0	-91.8	-91.8	0.89 (1)	3.45	B-O	0 / 2020
I-J	0 / 35	-91.8	-91.8	0.12 (1)	10.00	L-I	0 / 2020
R-B	-2009 / 0	0.0	0.0	0.21 (1)	5.95		
K-I	-2009 / 0	0.0	0.0	0.21 (1)	5.95		
R-Q	0 / 0	-18.5	-18.5	0.25 (4)	10.00		
Q-P	0 / 1999	-18.5	-18.5	0.45 (1)	10.00		
P-O	0 / 1999	-18.5	-18.5	0.45 (1)	10.00		
O-N	0 / 1538	-18.5	-18.5	0.33 (1)	10.00		
N-M	0 / 1999	-18.5	-18.5	0.45 (1)	10.00		
M-L	0 / 1999	-18.5	-18.5	0.45 (1)	10.00		
L-K	0 / 0	-18.5	-18.5	0.24 (4)	10.00		

TOTAL WEIGHT = 2 X 166 = 333 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CSI: TC=0.89/1.00 (B-C:1), BC=0.45/1.00 (O-Q:1), WB=0.45/1.00 (B-Q:1), SS=0.27/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.90 (F) (INPUT = 0.90)
JSI METAL=0.68 (P) (INPUT = 1.00)




Structural component only
DWG# T-2007019

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408131	T9	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:07:26 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-FYW341F1e?g?6kzwJog3TZ5QEjI22p3cidX2JyzNDbv

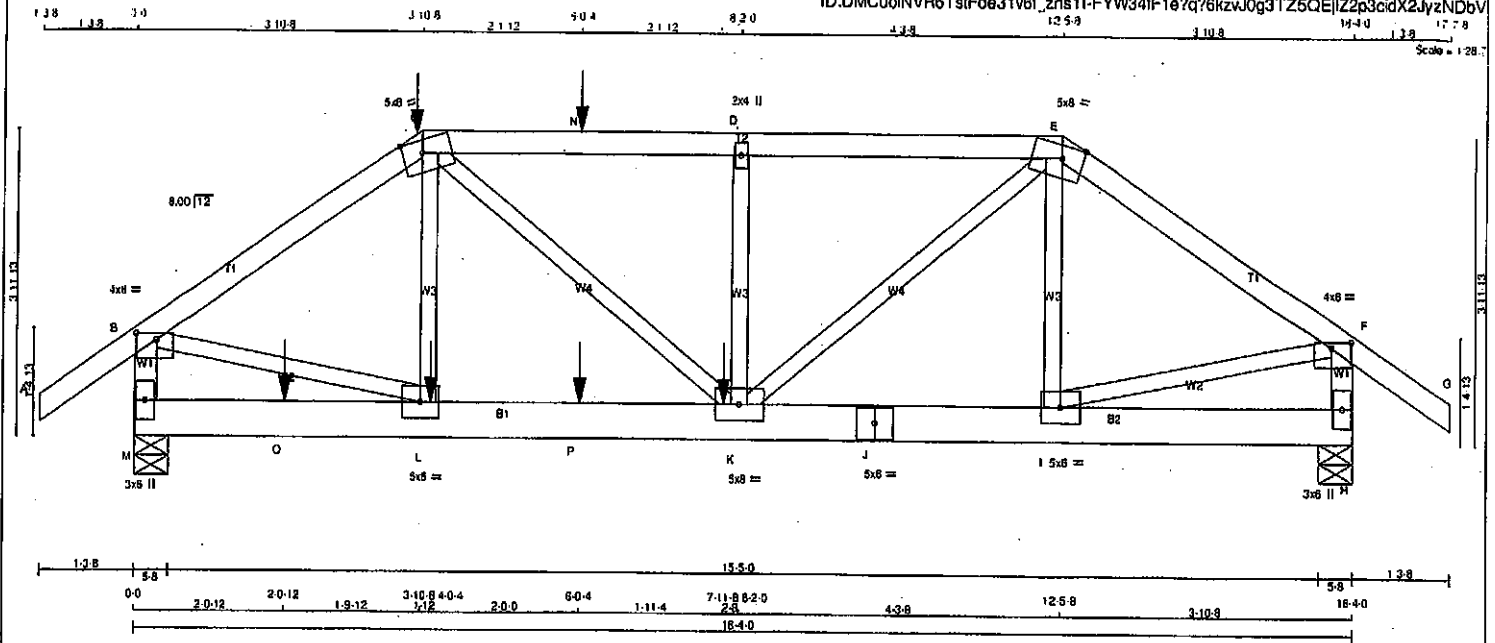

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
E - G	2x4	DRY	No.2	SPF	
G - H	2x4	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
J - L	2x6	DRY	No.2	SPF	
L - H	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
DRY; SEASONED LUMBER.					

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	8.0	1.00	3.25	
C	TTWW-m	MT20	5.0	8.0	2.00	3.25	
D	TMVW-w	MT20	2.0	4.0			
E	TTWW-m	MT20	5.0	8.0	2.00	3.25	
F	TMVW-p	MT20	4.0	8.0	1.00	3.25	
H	BMV1+p	MT20	3.0	6.0			
I	BMVW-I	MT20	5.0	8.0			
J	BS-I	MT20	5.0	8.0			
K	BMVWW-I	MT20	5.0	8.0			
L	BMVW-I	MT20	5.0	8.0			
M	BMV1+p	MT20	3.0	6.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
M	1879	0	1679	0
H	1496	0	1496	0

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
M	COMBINED	803 / 0	0 / 0	0 / 0	380 / 0	0 / 0
H	COMBINED	717 / 0	0 / 0	0 / 0	336 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.17 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD LC1	MAX	MAX.	MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD LC1	MAX	MAX.
MEMB.	FORCE (LBS)	FORCE (LBS)	FROM	TO	LENGTH	FR-TO	MEMB.	FORCE (LBS)	FORCE (LBS)	FROM	TO
A-B	0 / 35	-91.8	-91.8	0.14 (1)	10.00	L-C	-218 / 28	0.05 (1)			
B-C	-1751 / 0	-91.8	-91.8	0.33 (1)	4.68	C-K	0 / 874	0.22 (1)			
C-N	-2118 / 0	-91.8	-91.8	0.42 (1)	4.17	K-D	-523 / 0	0.13 (1)			
N-D	-2118 / 0	-91.8	-91.8	0.42 (1)	4.17	K-E	0 / 1120	0.28 (1)			
D-E	-2118 / 0	-91.8	-91.8	0.42 (1)	4.17	I-E	-203 / 0	0.05 (1)			
E-F	-1523 / 0	-91.8	-91.8	0.31 (1)	4.94	B-L	0 / 1469	0.37 (1)			
F-G	0 / 35	-91.8	-91.8	0.14 (1)	10.00	I-F	0 / 1304	0.32 (1)			
M-B	-1643 / 0	0.0	0.0	0.18 (1)	8.42						
H-F	-1469 / 0	0.0	0.0	0.18 (1)	8.71						
M-O	0 / 0	-18.5	-18.5	0.05 (4)	10.00						
O-L	0 / 0	-18.5	-18.5	0.05 (4)	10.00						
L-P	0 / 1448	-18.5	-18.5	0.26 (1)	10.00						
P-K	0 / 1448	-18.5	-18.5	0.26 (1)	10.00						
K-J	0 / 1259	-18.5	-18.5	0.23 (1)	10.00						
J-I	0 / 1259	-18.5	-18.5	0.23 (1)	10.00						
I-H	0 / 0	-18.5	-18.5	0.04 (4)	10.00						

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	3-10-8	-255	-255	---	FRONT	VERT	TOTAL	C1
K	7-11-8	-729	-729	---	FRONT	VERT	TOTAL	C1
L	4-0-4	-17	-17	---	FRONT	VERT	TOTAL	C1
N	8-0-4	-86	-86	---	FRONT	VERT	TOTAL	C1
O	2-0-12	-17	-17	---	FRONT	VERT	TOTAL	C1
P	8-0-4	-17	-17	---	FRONT	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 78 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
DL =	8.0	PSF	
BOT CH.	LL =	0.0	PSF
DL =	7.4	PSF	
TOTAL LOAD =	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.54")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.05")
ALLOWABLE DEFL.(TL) = $L/360$ (0.54")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.08")

CSI: TC=0.42/1.00 (C-D:1), BC=0.26/1.00 (K-L:1), WB=0.37/1.00 (B-L:1), SI=0.25/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618 354 1887 788 1987 1658	MAX MIN MAX MIN MAX MIN

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.85 (E) (INPUT = 0.90)
JSI METAL= 0.40 (F) (INPUT = 1.00)



Structural component only
DWG# T-2007020

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408131	T10	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 10:07:27 2020 Page 1
ID:DMCubINVR6TstFoe31v61_zns11-j4RI?GfPlyskuY5sB10neb07f4nJ2lxHGbOzNDbU

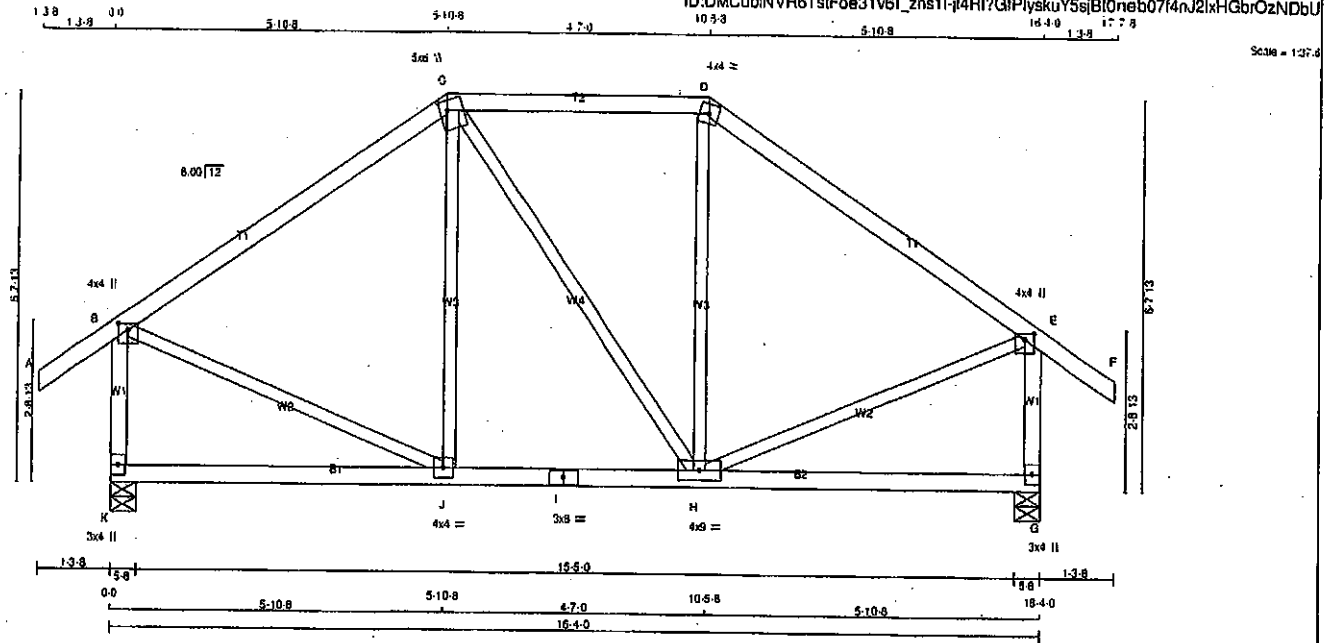

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
K - B	2x4	DRY	No.2	SPF	
G - E	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
I - G	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TTWW+m	MT20	5.0	8.0	2.00	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMVW+p	MT20	4.0	4.0	1.25	2.00
G	BMV1+p	MT20	3.0	4.0		
H	BMVWW-i	MT20	4.0	9.0		
I	BS-I	MT20	3.0	6.0		
J	BMVWW-i	MT20	4.0	4.0		
K	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
K	1026	0	1026	0	5-8	5-8
G	1026	0	1026	0	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	723	488 / 0	0 / 0	0 / 0	0 / 0	235 / 0	0 / 0
G	723	488 / 0	0 / 0	0 / 0	0 / 0	235 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	J-C	-115 / 40	0.08 (1)
B-C	-655 / 0	-91.8	-91.8 0.41 (1)	8.25	C-H	0 / 0	0.00 (1)
C-D	-542 / 0	-91.8	-91.8 0.25 (1)	6.25	H-D	-116 / 40	0.08 (1)
D-E	-655 / 0	-91.8	-91.8 0.41 (1)	8.25	B-J	0 / 587	0.13 (1)
E-F	0 / 35	-91.8	-91.8 0.12 (1)	10.00	H-E	0 / 587	0.13 (1)
K-B	-980 / 0	0.0	0.0 0.14 (1)	7.81			
G-E	-979 / 0	0.0	0.0 0.14 (1)	7.81			
K-J	0 / 0	-18.5	-18.5 0.14 (4)	10.00			
J-I	0 / 543	-18.5	-18.5 0.17 (4)	10.00			
I-H	0 / 543	-18.5	-18.5 0.17 (4)	10.00			
H-G	0 / 0	-18.5	-18.5 0.14 (4)	10.00			

TOTAL WEIGHT = 2 X 75 = 150 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.41/1.00 (B-C:1), BC=0.17/1.00 (H-J:4), WB=0.13/1.00 (B-J:1), SI=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1887
	618	354	1887

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (B) (INPUT = 0.90)
JSI METAL = 0.21 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007021

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408131	T12	3	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitex Industries, Inc. Sat Apr 25 10:07:29 2020 Page 1
ID:DMCubINVR6TstFoe31v6l zns11-H7CCjhHvwwCazBhU_8Dm5Cj_?xJ9F7C2PblivGzNDbS

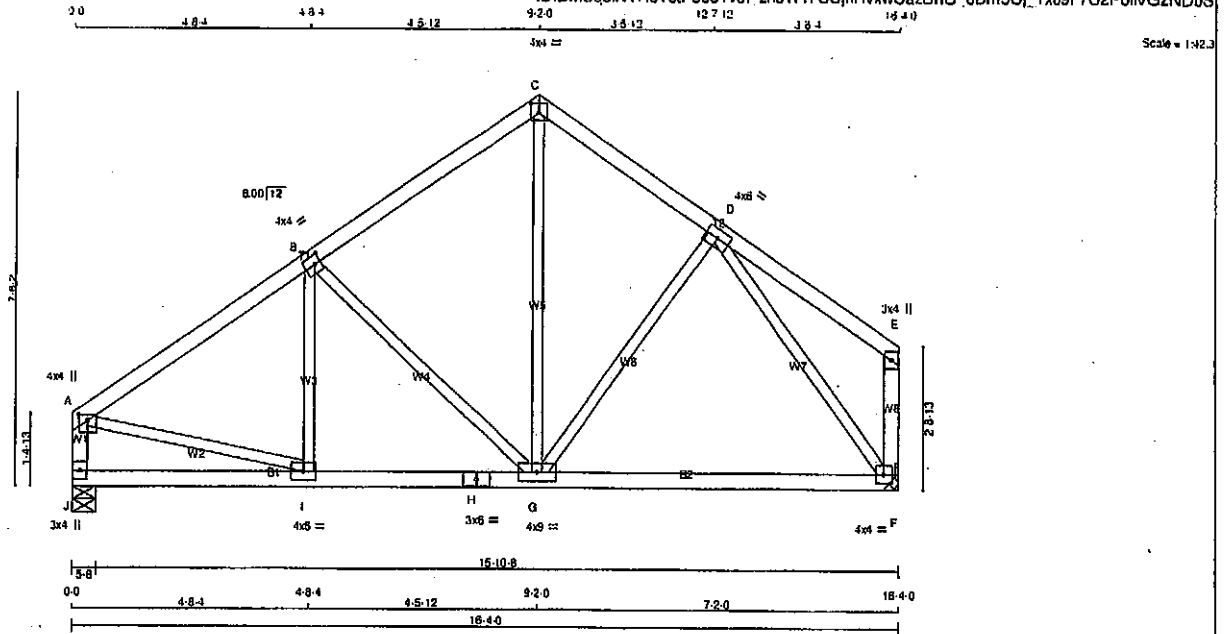

TOTAL WEIGHT = 3 X 71 = 214 lb (M/F)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
J - A	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

<u>PLATES (table is in inches)</u>						
JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TMVW-t	MT20	4.0	4.0	2.00	1.50
C	TTVW-p	MT20	4.0	4.0	2.25	2.00
D	TMVW-t	MT20	4.0	6.0		
E	TMV+p	MT20	3.0	4.0		
F	BMVW-t	MT20	4.0	4.0		
G	BMVWV-t	MT20	4.0	9.0		
H	BS-t	MT20	3.0	6.0		
I	BMVW-t	MT20	4.0	6.0		
J	BMV+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT VERT	HORZ	DOWN	HORZ	UPLIFT
J	900	0	900	0
F	900	0	900	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3-8.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS						
JT COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
J	637	418 / 0	0 / 0	0 / 0	219 / 0	0 / 0	
F	637	418 / 0	0 / 0	0 / 0	219 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.17 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 MAX (PLF) CSI (LC)	MEMB.	FORCE (LBS) MAX (LC)
FR-TO		FROM TO	FR-TO	
A-B	-904 / 0	-91.8 -91.8 0.25 (1)	I-B	-104 / 26
B-C	-848 / 0	-91.8 -91.8 0.25 (1)	B-G	-358 / 0
C-D	-840 / 0	-91.8 -91.8 0.15 (1)	G-C	0 / 407
D-E	0 / 21	-91.8 -91.8 0.19 (1)	G-D	-37 / 32
J-A	-861 / 0	0.0 0.0 0.09 (1)	A-I	0 / 795
F-E	-128 / 0	0.0 0.0 0.02 (1)	D-F	-886 / 0
J-I	0 / 0	-18.5 -18.5 0.09 (4)		
I-H	0 / 775	-18.5 -18.5 0.26 (4)		
H-G	0 / 775	-18.5 -18.5 0.26 (4)		
G-F	0 / 537	-18.5 -18.5 0.24 (4)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BOBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = U/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = U/999 (0.09")

CSK: TC=0.25/1.00 (A-B:1), BC=0.26/1.00 (G-I:4), WB=0.54/1.00 (D-F:1), SSI=0.17/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1607 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (A) (INPUT = 0.90)
JSI METAL= 0.29 (H) (INPUT = 1.00)



Structural component only
DWG# T-2007023

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408131	T13	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

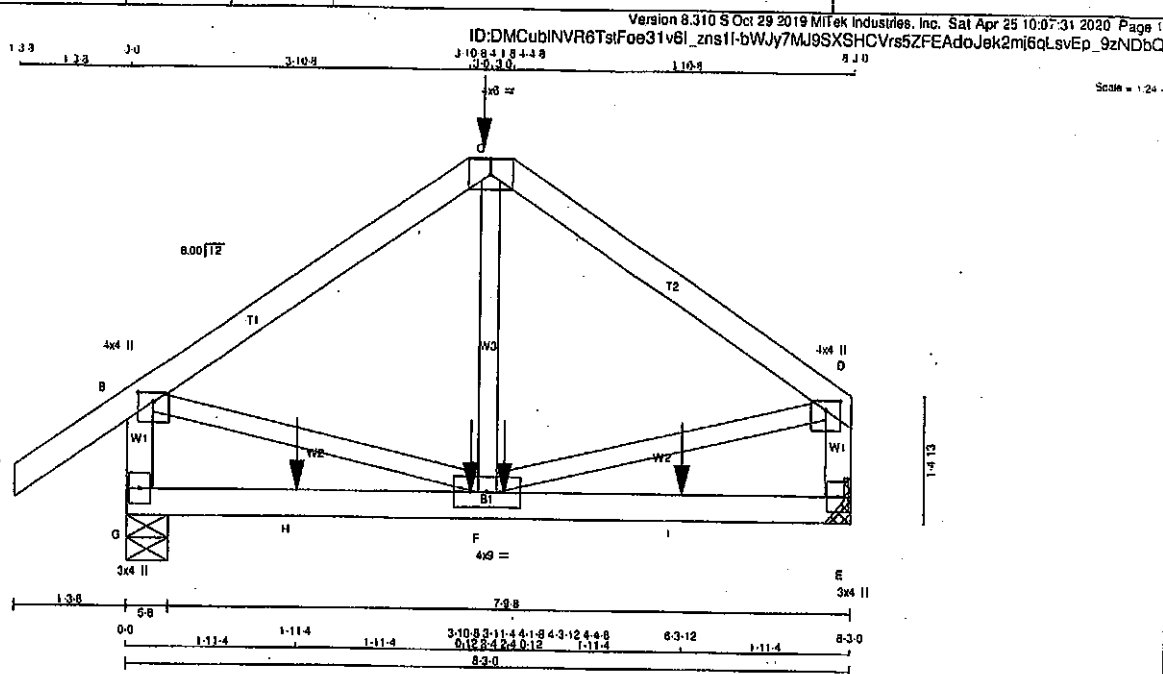

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	NO.2
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - B	2x4	DRY	No.2
E - D	2x4	DRY	No.2
G - E	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2

EXCEPT

PLATES (table in in (inches))			
JT	TYPE	PLATES	W LEN Y X
B	TMVW+p	MT20	4.0 4.0 1.25 2.00
C	TTW+p	MT20	4.0 6.0
D	TMVW+p	MT20	4.0 4.0 1.25 2.00
E	BMV1+p	MT20	3.0 4.0
F	BMVWW-I	MT20	4.0 9.0
G	BMV1+p	MT20	3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	DOWN	BRG	BRG
G	879	0	879	0	5-8
E	753	0	753	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
G	819	420 / 0	0 / 0	0 / 0	0 / 0	199 / 0	0 / 0
E	533	350 / 0	0 / 0	0 / 0	0 / 0	183 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED MAX. CS (LC)
FR-TO			
A-B	0 / 35	-91.8	-91.8 0.14 (1)
B-C	-682 / 0	-91.8	-91.8 0.31 (1)
C-D	-682 / 0	-91.8	-91.8 0.31 (1)
G-B	-842 / 0	0.0	0.0 0.10 (1)
E-D	-716 / 0	0.0	0.0 0.08 (1)
G-H	0 / 0	-18.5	-18.5 0.13 (4)
H-F	0 / 0	-18.5	-18.5 0.13 (4)
F-I	0 / 0	-18.5	-18.5 0.13 (4)
I-E	0 / 0	-18.5	-18.5 0.13 (4)

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-1-8	-527	-527	---	BACK	VERT	TOTAL	---	C1
F	3-11-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
F	4-3-12	-17	-17	---	BACK	VERT	TOTAL	---	C1
H	1-11-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
I	6-3-12	-17	-17	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 34 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.28")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.31/1.00 (C-D:1), BC=0.13/1.00 (E-F:4), WB=0.15/1.00 (B-F:1), SSI=0.14/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1687

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (8) (INPUT = 0.90)
JSI METAL= 0.20 (8) (INPUT = 1.00)



Structural component only
DWG# T-2007024

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408131	T14	2	1	GREEN PARK HOMES	
Tamarack Pool Truss, Burlington		TRUSS DESC.			

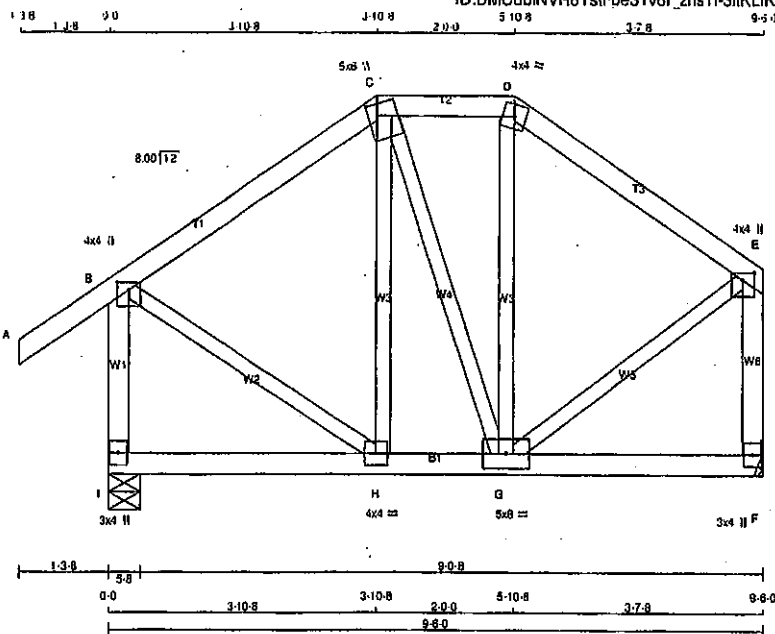

TOTAL WEIGHT = 2 X 50 = 99 lb (M/F)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2		
C - D	2x4	DRY	No.2		
D - E	2x4	DRY	No.2		
E - F	2x4	DRY	No.2		
F - G	2x4	DRY	No.2		
G - H	2x4	DRY	No.2		

ALL WEBS 2x3 DRY No.2
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE PLATES				
B TMVW+p MT20	4.0	4.0	1.25	2.00
C TTWW+m MT20	5.0	6.0	2.00	1.50
D TTW-m MT20	4.0	4.0		
E TMVW+p MT20	4.0	4.0	1.25	2.00
F BMV1+p MT20	3.0	4.0		
G BMWW-i MT20	5.0	8.0		
H BMWW-i MT20	4.0	4.0		
I BMV1+p MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT GROSS REACTION			BRG	BRG
I 850 0	850 0	0 0	5-8	5-8
F 524 0	524 0	0 0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS	1ST LCASE	MAX./MIN. COMPONENT REACTIONS
JT COMBINED		
I 457	313/0	0/0
F 370	243/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORIZ. LOAD (LC1)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)
A-B	0/35	-91.8	-91.8	0.12 (1)	10.00	H-C	-87/16	0.04 (1)	
B-C	-297/0	-91.8	-91.8	0.18 (1)	8.25	C-G	-19/0	0.01 (1)	
C-D	-238/0	-91.8	-91.8	0.05 (1)	6.25	G-D	-97/9	0.04 (1)	
D-E	-289/0	-91.8	-91.8	0.15 (1)	8.25	S-H	0/288	0.06 (1)	
E-F	-618/0	0.0	0.0	0.09 (1)	7.81	G-E	0/292	0.07 (1)	
F-G	-493/0	0.0	0.0	0.08 (1)	7.81				
H-I	0/0	-18.5	-18.5	0.08 (4)	10.00				
H-G	0/245	-18.5	-18.5	0.08 (4)	10.00				
G-F	0/0	-18.5	-18.5	0.05 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2016

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.32")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.32")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.18/1.00 (B-C-I), BC=0.08/1.00 (G-H-I4), WB=0.07/1.00 (E-G-I), SS=0.12/1.00 (B-C-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.43 (B) (INPUT = 0.90)
JSI METAL= 0.13 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007025

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408131	T15	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:07:33 2020 Page 1
ID:DMCubINVR6TstFoe31v8l zns11-XvRiY2KQ 8f?Sp?FD NF2uhnYjv811eJDjv22zND6O

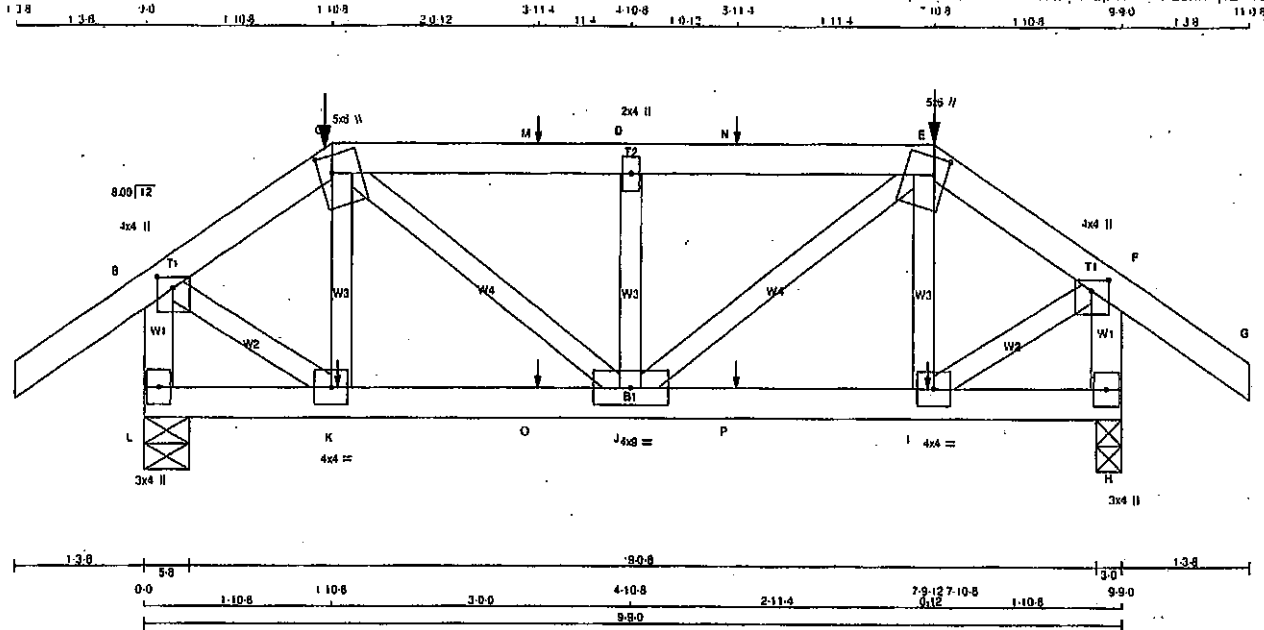

TOTAL WEIGHT = 43 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
E - G	2x4	DRY	No.2	SPF	
G - I	2x4	DRY	No.2	SPF	
I - K	2x4	DRY	No.2	SPF	
K - L	2x4	DRY	No.2	SPF	
L - H	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
DRY: SEASONED LUMBER.					

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT VERT	706	0	0	5-8
L VERT	706	0	0	5-8
H VERT	706	0	0	3-0

UNFACTORED REACTIONS	1ST LC CASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	SNOW	LIVE
L 498	343 / 0	0 / 0
H 498	343 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (7)

CHORDS	MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED	CS (LC)	UNBRAC	MEMB.	FORCE (LBS)	MAX. FACTORED	CS (LC)
FR-TO	FROM	TO	LENGTH	FR-TO	FROM	TO	LENGTH	FR-TO	FROM	TO
A-B	0 / 35	-91.8	-91.8	0.14 (1)	10.00	K-C	-140 / 0	0.02 (1)		
B-C	-458 / 0	-91.8	-91.8	0.13 (1)	8.25	C-J	0 / 304	0.08 (1)		
C-M	-590 / 0	-91.8	-91.8	0.14 (1)	8.25	J-D	-329 / 0	0.08 (1)		
M-D	-590 / 0	-91.8	-91.8	0.14 (1)	8.25	J-E	0 / 304	0.08 (1)		
D-N	-590 / 0	-91.8	-91.8	0.14 (1)	8.25	I-E	-140 / 0	0.02 (1)		
N-E	-590 / 0	-91.8	-91.8	0.14 (1)	8.25	B-K	0 / 407	0.10 (1)		
E-F	-458 / 0	-91.8	-91.8	0.13 (1)	8.25	I-F	0 / 407	0.10 (1)		
F-G	0 / 35	-91.8	-91.8	0.14 (1)	10.00					
L-B	-893 / 0	0.0	0.0	0.08 (1)	7.81					
H-F	-893 / 0	0.0	0.0	0.08 (1)	7.81					
L-K	0 / 0	-18.5	-18.5	0.03 (4)	10.00					
K-O	0 / 351	-18.5	-18.5	0.08 (1)	10.00					
O-J	0 / 351	-18.5	-18.5	0.08 (1)	10.00					
J-P	0 / 351	-18.5	-18.5	0.08 (1)	10.00					
P-I	0 / 351	-18.5	-18.5	0.08 (1)	10.00					
I-H	0 / 0	-18.5	-18.5	0.03 (4)	10.00					

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	1-10-8	-42	-42	115	BACK	VERT	TOTAL	---	---	C1
E	7-10-8	-42	-42	115	BACK	VERT	TOTAL	---	---	C1
I	7-9-12	1	1	---	BACK	VERT	TOTAL	---	---	C1
K	1-11-4	1	1	---	BACK	VERT	TOTAL	---	---	C1
M	3-11-4	1	1	115	BACK	VERT	TOTAL	---	---	C1
N	5-11-4	1	1	115	BACK	VERT	TOTAL	---	---	C1
O	3-11-4	1	1	---	BACK	VERT	TOTAL	---	---	C1
P	5-11-4	1	1	---	BACK	VERT	TOTAL	---	---	C1

CONNECTION REQUIREMENTS

I) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.32")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.32")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSK: TC=0.14/1.00 (D-E:1), BC=0.08/1.00 (I-J:1), WB=0.10/1.00 (F-I:1), SS=0.14/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.40 (F) (INPUT = 0.90)
JSI METAL= 0.14 (F) (INPUT = 1.00)

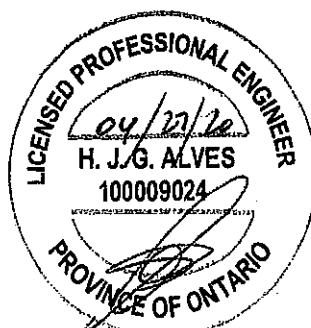


Structural component only
DWG# T-2007026

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408131	T16	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:07:34 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns11-0575mOL2Srs3zaRnhpkoFQpGy08wRonYITbUzND6N

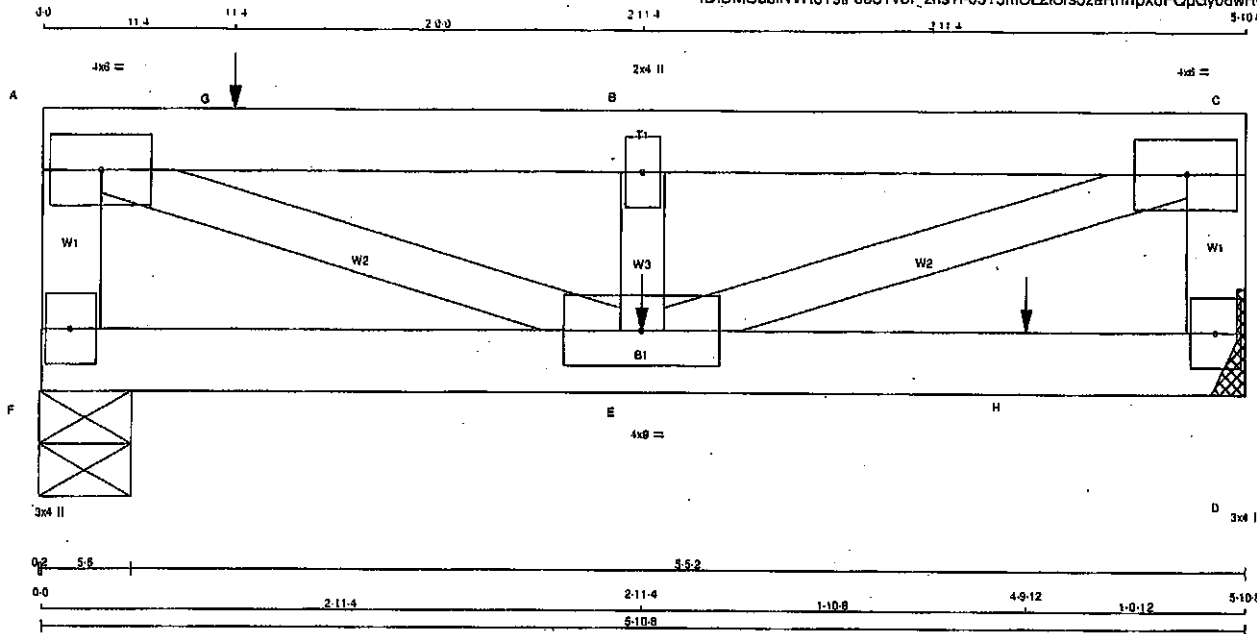

TOTAL WEIGHT = 2 X 20 = 40 lb

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR
F - A		2x4	DRY	No.2	SPF
A - C		2x4	DRY	No.2	SPF
D - C		2x4	DRY	No.2	SPF
F - D		2x4	DRY	No.2	SPF
ALL WEBS		2x3	DRY	No.2	SPF

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS / ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F - A	12	TOP
A - C	12	TOP
C - D	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D	11	SIDE (97.1)
WEBS : (0.122"x3") SPIRAL NAILS		
B - E	6	SIDE (34.7)
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3.0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	4.0	6.0		
B	TMVW-w	MT20	2.0	4.0		
C	TMVW-1	MT20	4.0	6.0		
D	BMV1ap	MT20	3.0	4.0		
E	BMVWW-1	MT20	4.0	9.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
F	1280	0	1280	0
D	1162	0	1162	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 2.0.

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM/LIVE	WIND	DEAD	SOIL
F	895	563/0	0/0	0/0	0/0	333/0	0/0
D	826	518/0	0/0	0/0	0/0	308/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC)	UNBRACED LENGTH	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC)
FR-TO		FROM TO				FR-TO		
F-A	-1214/0	0.0	0.0	0.07 (1)	7.81	A-E	0/2094	0.26 (1)
A-G	-1973/0	-91.8	-91.8	0.35 (1)	5.75	E-B	-548/0	0.04 (1)
G-B	-1973/0	-91.8	-91.8	0.35 (1)	5.75	E-C	0/2084	0.26 (1)
B-C	-1973/0	-91.8	-91.8	0.10 (1)	6.14			
D-C	-794/0	0.0	0.0	0.04 (1)	7.81			
F-E	0/0	-43.5	-43.5	0.06 (4)	10.00			
E-H	0/0	-43.5	-43.5	0.27 (1)	10.00			
H-D	0/0	-43.5	-43.5	0.27 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	2-11-4	-505	-505	---	FRONT	VERT	TOTAL	---	C1
G	11-4	-817	-817	---	TOP	VERT	TOTAL	---	C1
H	4-9-12	-505	-505	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.02")
ALLOWABLE DEFL. (TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.04")

CSI: TC=0.35/1.00 (A-E:1), 8C=0.27/1.00 (D-E:1).
WB=0.28/1.00 (A-E:1), SSI=0.22/1.00 (A-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.88 (C) INPUT=0.88
JSI METAL=0.25 (C) INPUT=1.00

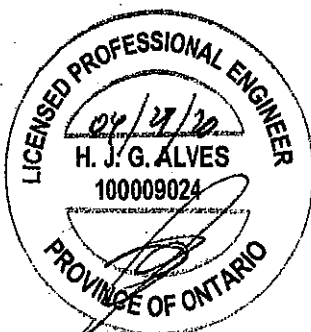

Structural component only
DWG# T-2007027 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408131	T16	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 28 2019 Mitek Industries, Inc. Sat Apr 25 10:07:34 2020 Page 2
ID:DMCubiNVR6TstFoe31v6I zns11-0575mOL2ISrs3zaRnhpxoFQpGy08wRonYITtbUzNDbN


PLATES (table/s in inches)

JT	TYPE	PLATES	W	LEN	Y	X
F	BMV1+p	MT20	3.0	4.0		



Structural component only
DWG# T-2007027 2/2

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:07:35 2020 Page 1
ID:DMCubINVR6TslFoe31v6l_zns1I-UHZTzkMgWmzjh69eKPKAKTzvlHJlfnxnxXC07wzNdbM

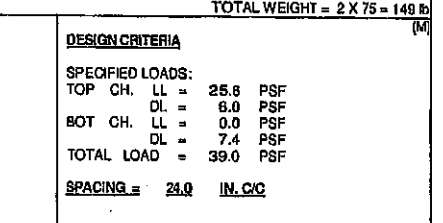

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018 , OBC 2012 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEFL.(LL)= $L/360$ (0.61")
CALCULATED VERT. DEFL.(LL) = $L/884$ (0.23")
ALLOWABLE DEFL.(TL)= $L/360$ (0.61")

CALCULATED VERT. DEFL(TL) = 1/521 (0.42)
 CSI: TC=0.81/1.00 (D-E:1), BC=0.80/1.00 (H-J:1),
 WB=0.71/1.00 (E-H:1), SSI=0.31/1.00 (E-F:1)
 DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00
 COMPANION LIVE LOAD FACTOR = 1.00
 TRUSS PLATE MANUFACTURER IS NOT
 RESPONSIBLE FOR QUALITY CONTROL IN THE
 TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20 818 354	1687 788	1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (J) (INPUT = 0.90)

JSI METAL= 0.85 (I) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408131	T17	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 10:07:35 2020 Page 2
ID:DMCubINVR6TstFoe31v6l zns11-UH2TzKmqWmzh69eKPKAKTzvzLHJlnznXC07wzNDbM

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	5.0	6.0	2.50	2.00
B	TMVW-w	MT20	3.0	6.0		
C	TS-1	MT20	5.0	6.0		
D	TMVW-1	MT20	5.0	6.0		
E	TMVW-1	MT20	7.0	16.0	3.50	4.50
G	BMV+p	MT20	3.0	4.0		
H	BMVW-1	MT20	5.0	6.0	2.25	2.00
I	BS-1	MT20	3.0	6.0		
J	BMVW-1	MT20	5.0	6.0	2.25	3.50
K	BMV1+p	MT20	3.0	4.0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
R	4-0-12	-49	-49	---	BACK	VERT	TOTAL	---	C1
S	10-0-12	-49	-49	---	BACK	VERT	TOTAL	---	C1
T	14-0-12	-49	-49	---	BACK	VERT	TOTAL	---	C1
U	16-0-12	-49	-49	---	BACK	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408132	T20	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 10:24:27 2020 Page 1
ID:DMCubINVR6TstFoe31v6I zns11-r i2NmctBt75eW8dxUvLlusAljpmWQuUzLagGzNDLY

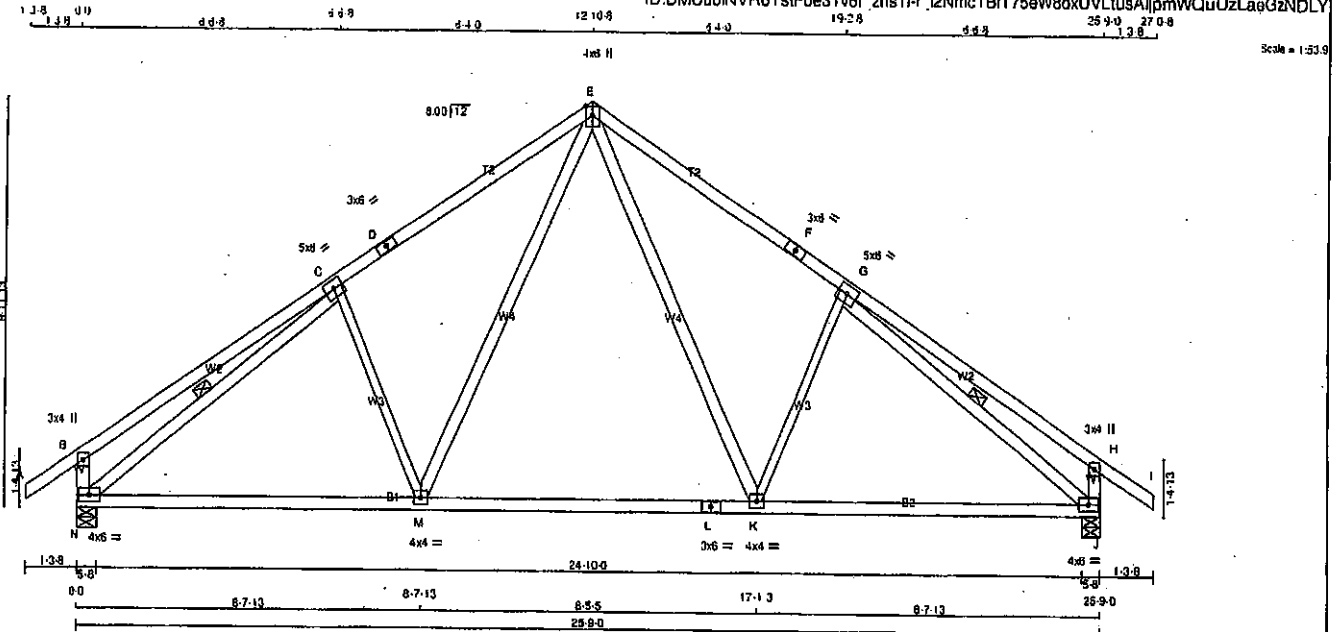

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR
A - D	2x4	DRY	No.2	SPF		
D - E	2x4	DRY	No.2	SPF		
E - F	2x4	DRY	No.2	SPF		
F - I	2x4	DRY	No.2	SPF		
N - B	2x4	DRY	No.2	SPF		
J - H	2x4	DRY	No.2	SPF		
N - L	2x4	DRY	No.2	SPF		
L - J	2x4	DRY	No.2	SPF		
ALL WEBS	2x4	DRY	No.2	SPF		
EXCEPT						
K - G	2x3	DRY	No.2	SPF		
C - M	2x3	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMVap	MT20	3.0	4.0			
C	TMWV-t	MT20	5.0	6.0			
D	TS-t	MT20	3.0	6.0			
E	TTWV-t	MT20	4.0	6.0	Edge		
F	TS-t	MT20	3.0	6.0			
G	TMWV-t	MT20	5.0	6.0			
H	TMVap	MT20	3.0	4.0			
J	BMVWV-t	MT20	4.0	6.0			
K	BMWV-t	MT20	4.0	4.0			
L	BS-t	MT20	3.0	6.0			
M	BMWV-t	MT20	4.0	4.0			
N	BMVWV-t	MT20	4.0	6.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORZ	UPLIFT
N	1545	0	1545	0
J	1545	0	1545	0

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
N	1091	729 / 0	0 / 0	0 / 0	0 / 0	362 / 0	0 / 0
J	1091	729 / 0	0 / 0	0 / 0	0 / 0	362 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, G-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	UNBRAC	LENGTH	FR-TO	WEBS	MEMB.	MAX. FACTORED	MAX
MEMB.	FORCE	(PLF)	(LBS)								FORCE	CS1 (LC)
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	E-K	0 / 619	0.10 (1)				
B-C	0 / 40	-91.8	-91.8	0.63 (1)	10.00	K-G	-428 / 0	0.25 (1)				
C-D	-1469 / 0	-91.8	-91.8	0.58 (1)	4.72	M-E	0 / 619	0.10 (1)				
D-E	-1469 / 0	-91.8	-91.8	0.58 (1)	4.72	C-M	-428 / 0	0.25 (1)				
E-F	-1469 / 0	-91.8	-91.8	0.58 (1)	4.72	N-C	-1767 / 0	0.59 (1)				
F-G	-1469 / 0	-91.8	-91.8	0.58 (1)	4.72	G-J	-1767 / 0	0.59 (1)				
G-H	0 / 40	-91.8	-91.8	0.63 (1)	10.00							
H-I	0 / 35	-91.8	-91.8	0.12 (1)	10.00							
N-B	-347 / 0	0.0	0.0	0.04 (1)	7.81							
J-H	-347 / 0	0.0	0.0	0.04 (1)	7.81							
N-M	0 / 1356	-18.5	-18.5	0.42 (4)	10.00							
M-L	0 / 942	-18.5	-18.5	0.39 (4)	10.00							
L-K	0 / 942	-18.5	-18.5	0.39 (4)	10.00							
K-J	0 / 1356	-18.5	-18.5	0.42 (4)	10.00							

TOTAL WEIGHT = 4 X 121 = 486 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.88")
CALCULATED VERT. DEFL. (LL) = L/999 (0.06")
ALLOWABLE DEFL. (TL) = L/360 (0.88")
CALCULATED VERT. DEFL. (TL) = L/989 (0.19")

CS1: TC=0.63/1.00 (B-C:1), BC=0.42/1.00 (J-K:4), WB=0.59/1.00 (C-N:1), SS1=0.24/1.00 (C-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	818	354
	1887	788
	1887	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (J) (INPUT = 0.90)
JSI METAL = 0.46 (G) (INPUT = 1.00)




Structural component only
DWG# T-2007030

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408132	T21	4	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 2019 MITek Industries, Inc. Sat Apr 25 10:24:28 2020 Page 1
ID:DMCubINVR6TsiFoe31v6I_zns11-JAGQa6c5y7b_jo5KAi7ku4Q70i7hV_c1jd57AizNDLX

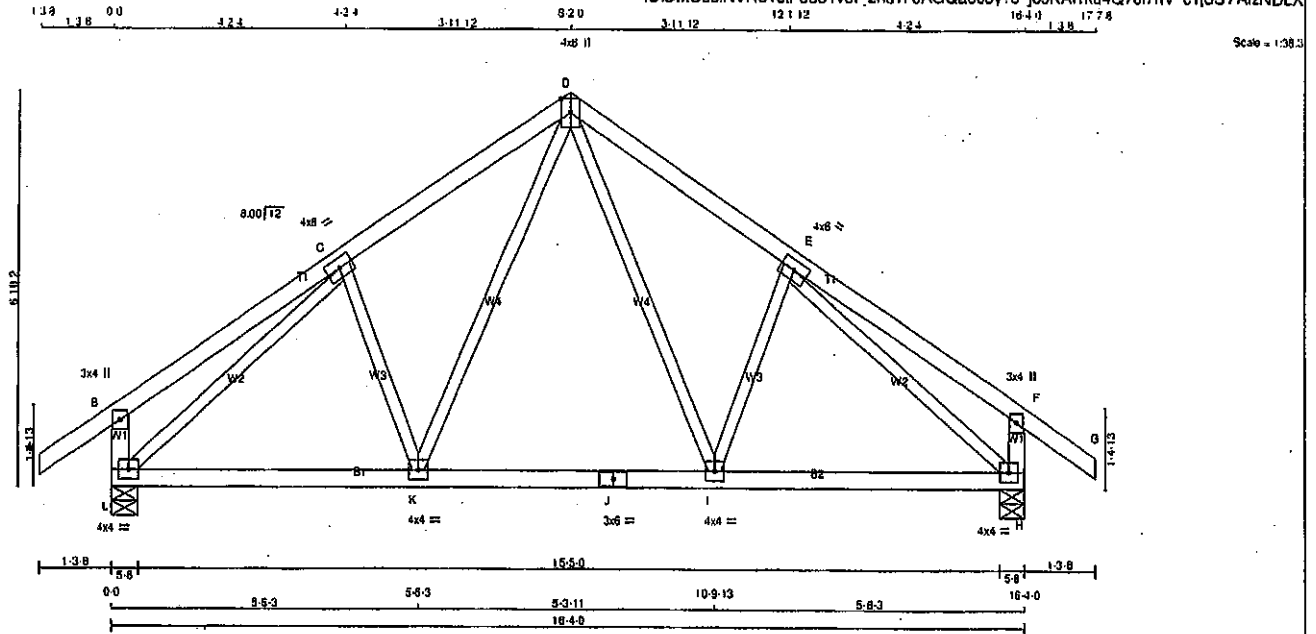

TOTAL WEIGHT = 4 X 73 = 291 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV-p	MT20	3.0	4.0
C	TMWV-i	MT20	4.0	6.0
D	TTWV-p	MT20	4.0	6.0
E	TMWV-i	MT20	4.0	6.0
F	TMV-p	MT20	3.0	4.0
H	BMWV-i	MT20	4.0	4.0
I	BMWV-i	MT20	4.0	4.0
J	BS-i	MT20	3.0	6.0
K	BMWV-i	MT20	4.0	4.0
L	BMWV-i	MT20	4.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORIZ	DOWN	HORIZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
L	1028	0	1028	0	0	5-8	5-8		
H	1028	0	1028	0	0	5-8	5-8		

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS		LIVE		PERM. LIVE		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	JT	COMBINED	SNOW	LIVE
L	723	488 / 0	0 / 0	0 / 0	0 / 0	235 / 0	0 / 0	L	723	488 / 0	0 / 0
H	723	488 / 0	0 / 0	0 / 0	0 / 0	235 / 0	0 / 0	H	723	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX (PLF)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX. CSI (LC)
FR-TO					FR-TO		
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	D-I	0 / 338	0.08 (1)
B-C	0 / 24	-91.8	-91.8 0.24 (1)	10.00	I-E	-219 / 0	0.06 (1)
C-D	-851 / 0	-91.8	-91.8 0.19 (1)	6.25	K-D	0 / 338	0.08 (1)
D-E	-851 / 0	-91.8	-91.8 0.19 (1)	6.25	C-K	-219 / 0	0.06 (1)
E-F	0 / 24	-91.8	-91.8 0.24 (1)	10.00	L-C	-1048 / 0	0.53 (1)
F-G	0 / 35	-91.8	-91.8 0.12 (1)	10.00	E-H	-1048 / 0	0.53 (1)
L-B	-269 / 0	0.0	0.0 0.03 (1)	7.81			
H-F	-269 / 0	0.0	0.0 0.03 (1)	7.81			
L-K	0 / 787	-18.5	-18.5 0.19 (1)	10.00			
K-J	0 / 561	-18.5	-18.5 0.17 (4)	10.00			
J-I	0 / 561	-18.5	-18.5 0.17 (4)	10.00			
I-H	0 / 787	-18.5	-18.5 0.19 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.54")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.54")
CALCULATED VERT. DEFL. (TL) = L/889 (0.05")

CSI: TC=0.24/1.00 (B-C:1), BC=0.19/1.00 (H-I:1), WB=0.53/1.00 (C-L:1), SS=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION (PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1887 788 1887 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (H) (INPUT = 0.90)
JSI METAL = 0.29 (L) (INPUT = 1.00)

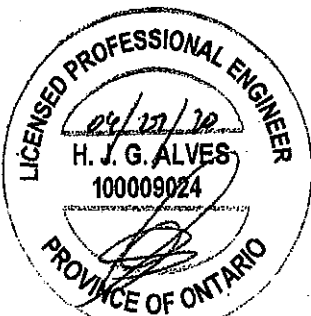

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 10:24:29 2020 Page 1

ID:DMCubINVR6TsFoe31v6l zns1f-oMqonSdJjrLvgWkMwZQzEG5QJEqIByHqgl9zNDLW

138 90 118 118 920 920 1448 1608 1640 1778 180 38 138

1x0 =


Scale: 1/8" = 1'-0"



Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.


MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LOAD CS1 (LX)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)	
FR-TO		FROM	TO		FR-TO			
A-B	0/35	-91.8	-91.8	0.12 (1)	10.00	K-D	0/405	0.09 (1)
B-C	-1592/0	-91.8	-91.8	0.38 (1)	4.83	K-E	-787/0	0.81 (1)
C-D	-823/0	-91.8	-91.8	0.47 (1)	8.01	C-K	-787/0	0.61 (1)
D-E	-823/0	-91.8	-91.8	0.47 (1)	8.01	N-L	-68/0	0.01 (1)
E-F	-1592/0	-91.8	-91.8	0.36 (1)	4.83	B-L	0/1383	0.31 (1)
F-G	0/35	-91.8	-91.8	0.12 (1)	10.00	J-H	-68/0	0.01 (1)
N-B	-874/0	0.0	0.0	0.10 (1)	7.81	J-F	0/1383	0.31 (1)
H-F	-974/0	0.0	0.0	0.10 (1)	7.81			
N-M	0/58	-18.5	-18.5	0.02 (4)	10.00			
M-L	0/19	0.0	0.0	0.09 (1)	10.00			
L-C	0/84	0.0	0.0	0.10 (1)	10.00			
L-K	0/1438	-18.5	-18.5	0.38 (1)	10.00			
K-J	0/1438	-18.5	-18.5	0.38 (1)	10.00			
I-J	0/19	0.0	0.0	0.09 (1)	10.00			
J-E	0/84	0.0	0.0	0.10 (1)	10.00			
I-H	0/58	-18.5	-18.5	0.02 (4)	10.00			

JSI GRIP = 0.69 (F) (INPUT = 0.90)
JSI METAL = 0.33 (L) (INPUT = 1.00)



JOB NAME 408133	TRUSS NAME T30	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 10:35:49 2020 Page 1
 ID:DMCubINVR6TsiF0e831v6l zns11-1BwtVzsFaFOMwSiCaAQ_h7CoDSjZzWGJ4ZgkzNDau
 3488352038-54 3.8 1.38
 Scale = 1:57.3

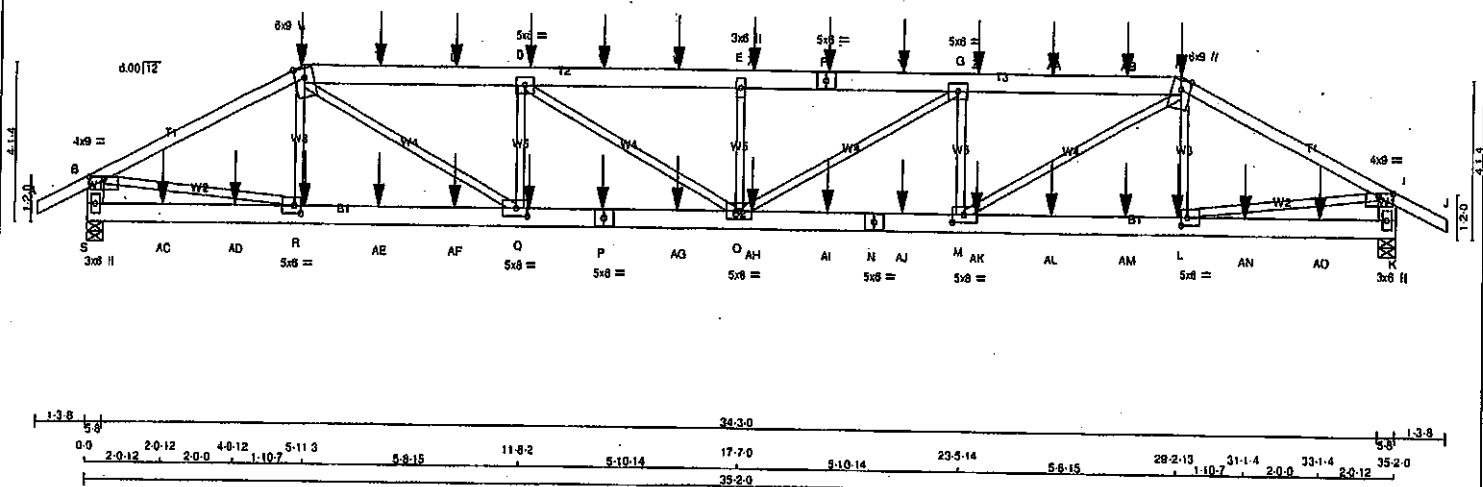

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - F	2x6	DRY	No.2	SPF	
F - H	2x6	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
S - B	2x6	DRY	No.2	SPF	
K - I	2x6	DRY	No.2	SPF	
S - P	2x6	DRY	No.2	SPF	
P - N	2x6	DRY	No.2	SPF	
N - K	2x6	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2
 EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 1	12	SIDE(61.0)
H - J 1	12	SIDE(61.0)
C - F 2	12	SIDE(183.1)
F - H 2	12	SIDE(61.0)
S - B 2	12	TOP
K - I 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S - P 2	12	SIDE(183.1)
P - N 2	12	SIDE(61.0)
N - K 2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED		MAXIMUM FACTORED		INPUT BRG	REQD BRG
	GROSS REACTION	GROSS REACTION	DOWN	HORIZ		
JT	3322	0	3322	0	5-8	5-8
S	3350	0	3350	0	5-8	5-8

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
JT	2350	1638 / 0	0 / 0	0 / 0	812 / 0	0 / 0
K	2370	1550 / 0	0 / 0	0 / 0	820 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.65 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 / 28	-91.8	-91.8 0.07 (1)	10.00	R-C	-413 / 18	0.05 (1)
B-C	-5064 / 0	-91.8	-91.8 0.52 (1)	3.87	L-H	-411 / 24	0.05 (1)
C-T	-7207 / 0	-91.8	-91.8 0.26 (1)	4.28	B-R	0 / 4581	0.57 (1)
T-U	-7207 / 0	-91.8	-91.8 0.26 (1)	4.28	L-I	0 / 4625	0.57 (1)
U-D	-7207 / 0	-91.8	-91.8 0.26 (1)	4.28	M-H	0 / 3123	0.39 (1)
D-V	-8028 / 0	-91.8	-91.8 0.26 (1)	4.09	C-Q	0 / 3143	0.39 (1)
V-W	-8028 / 0	-91.8	-91.8 0.26 (1)	4.09	M-G	-1484 / 0	0.18 (1)
W-E	-8028 / 0	-91.8	-91.8 0.26 (1)	4.09	Q-D	-1496 / 0	0.18 (1)
E-X	-8028 / 0	-91.8	-91.8 0.27 (1)	4.08	O-G	0 / 933	0.12 (1)
X-F	-8028 / 0	-91.8	-91.8 0.27 (1)	4.08	D-O	0 / 985	0.12 (1)
F-Y	-8028 / 0	-91.8	-91.8 0.27 (1)	4.08	O-E	-821 / 0	0.10 (1)
Y-G	-8028 / 0	-91.8	-91.8 0.27 (1)	4.08			
G-Z	-7234 / 0	-91.8	-91.8 0.26 (1)	4.27			
Z-AA	-7234 / 0	-91.8	-91.8 0.26 (1)	4.27			
AA-AB	-7234 / 0	-91.8	-91.8 0.26 (1)	4.27			
AB-H	-7234 / 0	-91.8	-91.8 0.26 (1)	4.27			
H-I	-5114 / 0	-91.8	-91.8 0.52 (1)	3.85			
I-J	0 / 28	-91.8	-91.8 0.07 (1)	10.00			
S-B	-3248 / 0	0.0	0.0 0.11 (1)	7.69			
K-I	-3276 / 0	0.0	0.0 0.12 (1)	7.67			

S-AC	0 / 0	-18.5	-18.5 0.06 (4)	10.00
AC-AD	0 / 0	-18.5	-18.5 0.06 (4)	10.00
AD-R	0 / 0	-18.5	-18.5 0.06 (4)	10.00
R-AE	0 / 4552	-18.5	-18.5 0.34 (1)	10.00
AE-AF	0 / 4552	-18.5	-18.5 0.34 (1)	10.00
AF-Q	0 / 4552	-18.5	-18.5 0.34 (1)	10.00
Q-P	0 / 7206	-18.5	-18.5 0.53 (1)	10.00
P-AG	0 / 7206	-18.5	-18.5 0.53 (1)	10.00
AG-O	0 / 7206	-18.5	-18.5 0.53 (1)	10.00
O-AH	0 / 7234	-18.5	-18.5 0.53 (1)	10.00
AH-AI	0 / 7234	-18.5	-18.5 0.53 (1)	10.00
AI-N	0 / 7234	-18.5	-18.5 0.53 (1)	10.00
N-AJ	0 / 7234	-18.5	-18.5 0.53 (1)	10.00
AJ-M	0 / 7234	-18.5	-18.5 0.53 (1)	10.00
M-AK	0 / 4596	-18.5	-18.5 0.35 (1)	10.00
AK-AL	0 / 4596	-18.5	-18.5 0.35 (1)	10.00
AL-AM	0 / 4596	-18.5	-18.5 0.35 (1)	10.00
AM-L	0 / 4596	-18.5	-18.5 0.35 (1)	10.00
L-AN	0 / 0	-18.5	-18.5 0.06 (4)	10.00
AN-AO	0 / 0	-18.5	-18.5 0.06 (4)	10.00
AO-K	0 / 0	-18.5	-18.5 0.06 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 6.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
 CALCULATED VERT. DEFL. (LL) = L/999 (0.21")
 ALLOWABLE DEFL. (TL) = L/360 (1.17")
 CALCULATED VERT. DEFL. (TL) = L/999 (0.39")

CSI: TC=0.52/1.00 (H-I:1), BC=0.53/1.00 (M-O:1), WB=0.57/1.00 (L-I:1), SSI=0.18/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1867 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.72 (R) (INPUT = 0.90)

JSI METAL = 0.68 (P) (INPUT = 1.00)

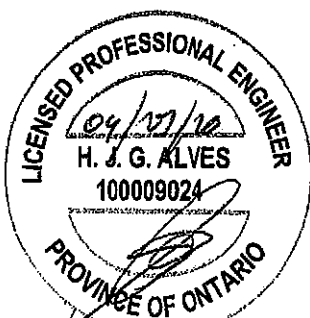

Structural component only
 DWG# T-2007041

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408133	T30	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 10:35:49 2020 Page 2
ID:DMCubINVR6TstFqg31v8l zns1I-BwtVzsFaFOMwSiCaAQ h7QoDSiZzWGJ4ZgakzNDAu

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	9.0	1.00	4.75
C	TTWW+m	MT20	6.0	9.0	Edge	
D	TMVW-l	MT20	5.0	6.0		
E	TMVW-w	MT20	3.0	6.0		
F	TS-l	MT20	5.0	6.0		
G	TMVW-l	MT20	5.0	6.0		
H	TTWW+m	MT20	6.0	9.0	Edge	
I	TMVW-p	MT20	4.0	9.0	1.00	4.75
K	BMV1+p	MT20	3.0	6.0		
L	BMVW-l	MT20	5.0	6.0	2.50	2.00
M	BMVW-l	MT20	5.0	6.0	2.50	3.75
N	BS-l	MT20	5.0	6.0		
O	BMVW-l	MT20	5.0	6.0		
P	BS-l	MT20	5.0	6.0		
Q	BMVW-l	MT20	5.0	6.0	2.50	3.75
R	BMVW-l	MT20	5.0	6.0	2.50	2.00
S	BMV1+p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-441	-441	---	BACK	VERT	TOTAL	---	C1
D	11-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
F	19-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
H	29-3-8	-441	-441	---	BACK	VERT	TOTAL	---	C1
L	29-2-13	-26	-26	---	BACK	VERT	TOTAL	---	C1
P	13-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
Q	11-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
R	5-11-3	-26	-26	---	BACK	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	13-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	15-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
X	17-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
Y	21-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
Z	23-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AA	25-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AB	27-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AC	2-0-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AD	4-0-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AE	7-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AF	9-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AG	15-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AH	17-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AI	19-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AJ	21-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AK	23-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AL	25-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AM	27-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AN	31-1-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AO	33-1-4	-26	-26	---	BACK	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

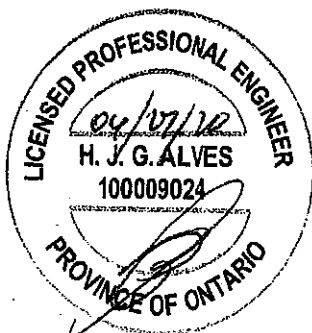

Structural component only
DWG# T-2007041

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ORWG NO.
408133	T30Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:35:50 2020 Page 1					
ID:DMCubINVR6TstFoe31v6f_zns1fLNUFJtL.YWDXbEP7uEIXvgatqGInbQYkID6BzNDAt					
34 3 35 2 0 38 5 6					
3 3 1 3 3					
Scale = 1:57.3					

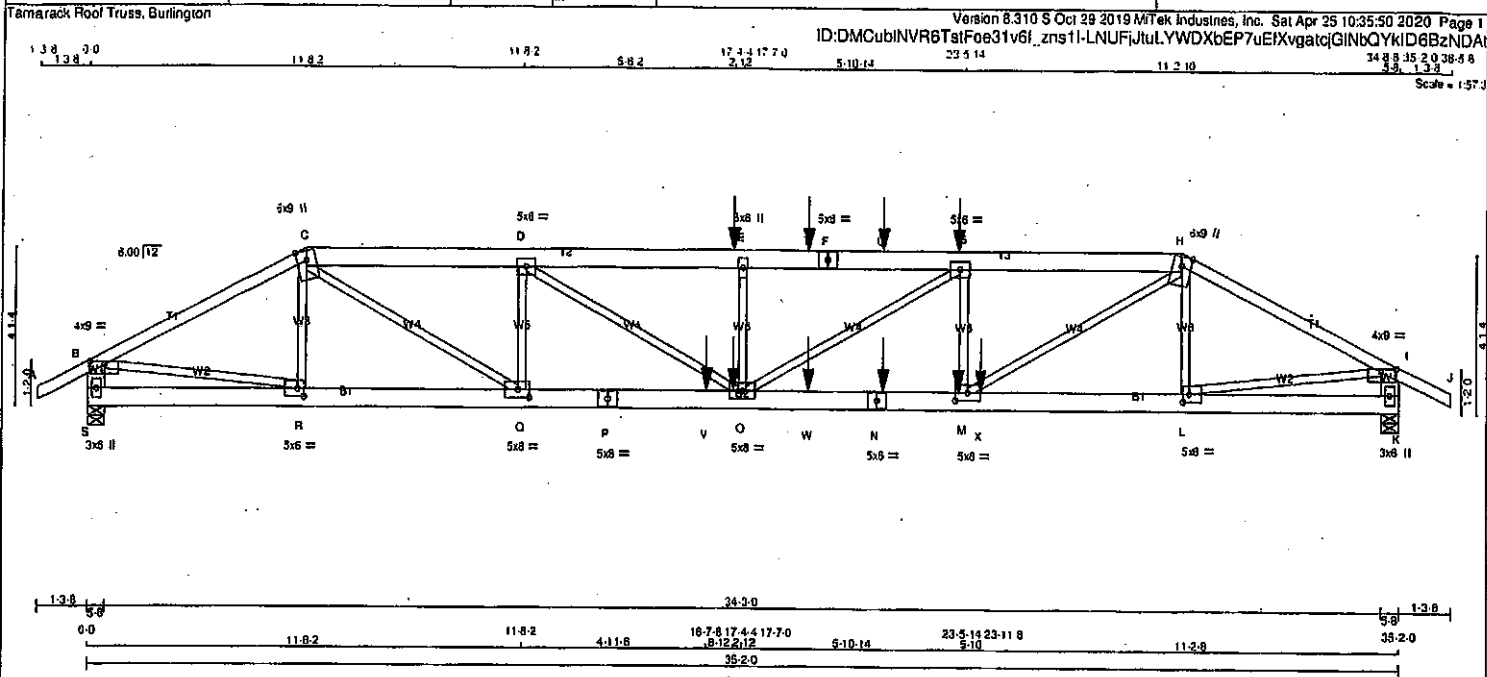

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - F	2x6	DRY	No.2	SPF	
F - H	2x6	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
S - B	2x6	DRY	No.2	SPF	
K - I	2x6	DRY	No.2	SPF	
S - P	2x6	DRY	No.2	SPF	
P - N	2x6	DRY	No.2	SPF	
N - K	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	12	TOP
H-J	12	TOP
C-F	2	SIDE(183.1)
F-H	2	SIDE(183.1)
S-B	2	TOP
K-I	2	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S-P	2	TOP
P-N	2	SIDE(183.1)
N-K	2	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	1	8

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	RECORD
JT	VERT	HORZ	DOWN	HORZ
S	3471	0	3471	0
K	4009	0	4009	0

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
S	2443	1648 / 0
K	2826	1908 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.41 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING	TOTAL LOAD CASES: (4)
CHORDS	WEBS
MEMB.	MEMB.
MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
VERT. LOAD (LBS)	VERT. LOAD (LBS)
LC1 MAX	LC1 MAX
CS1 (LC)	CS1 (LC)
UNBRACED LENGTH	UNBRACED LENGTH
FR-TO	FR-TO
A-B	0 / 28
B-C	-5351 / 0
C-D	-8760 / 0
D-E	-11225 / 0
E-F	-11225 / 0
F-G	-11225 / 0
G-H	-10273 / 0
H-I	-6380 / 0
I-J	0 / 28
J-K	-3409 / 0
K-L	-3978 / 0
S-R	0 / 0
R-Q	0 / 4813
Q-P	0 / 8760
P-V	0 / 8760
V-O	0 / 8760
O-W	0 / 10273
W-N	0 / 10273
N-M	0 / 10273
M-X	0 / 5718
X-L	0 / 5718
L-K	0 / 0

FACTORED CONCENTRATED LOADS (LBS)	LOC.	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
JT	17-4-4	-110	-110	---	FRONT	VERT	TOTAL	C1
E	23-4-4	-110	-110	---	FRONT	VERT	TOTAL	C1
G	23-4-4	-26	-26	---	FRONT	VERT	TOTAL	C1
M	21-4-4	-26	-26	---	FRONT	VERT	TOTAL	C1
N	17-4-4	-26	-26	---	FRONT	VERT	TOTAL	C1
O	19-4-4	-110	-110	---	FRONT	VERT	TOTAL	C1
T	21-4-4	-110	-110	---	FRONT	VERT	TOTAL	C1
U	18-7-8	-1364	-1364	---	FRONT	VERT	TOTAL	C1
V	19-4-4	-26	-26	---	FRONT	VERT	TOTAL	C1
W	23-11-8	-1443	-1443	---	FRONT	VERT	TOTAL	C1

CONNECTION REQUIREMENTS	1)	C1: A SUITABLE HANGER MECHANICAL CONNECTION IS REQUIRED.
-------------------------	----	--

TOTAL WEIGHT = 2 X 169 = 338 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/989 (0.30")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/765 (0.55")

CSI: TC=0.63/1.00 (H-I:1), BC=0.89/1.00 (O-Q:1), WB=0.71/1.00 (L-L:1), SS=0.48/1.00 (L-M:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1897 788 1897 1856

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.90 (R) (INPUT = 0.90)
JSI METAL = 0.91 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007042

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408133	T30Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc! Sat Apr 25 10:35:50 2020 Page 2

ID:DMCubINVR6TstF0e31v6l zns1I-LNUFJtULYWDXbEP7uEIXvqatciGINbQYKID6BzNDAt

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	4.0	9.0	1.00	4.75
C	TTWW+m	MT20	6.0	9.0	Edge	
D	TMWW-l	MT20	5.0	8.0		
E	TMW+w	MT20	3.0	8.0		
F	TS-l	MT20	5.0	8.0		
G	TMWW-l	MT20	5.0	8.0		
H	TTWW+m	MT20	6.0	9.0	Edge	
I	TMWV-p	MT20	4.0	9.0	1.00	4.75
K	BMV1+p	MT20	3.0	8.0		
L	BMWW-l	MT20	5.0	8.0	2.50	2.00
M	BMWW-l	MT20	5.0	8.0	2.50	3.75
N	BS-l	MT20	5.0	8.0		
O	BMWW-l	MT20	5.0	8.0		
P	BS-l	MT20	5.0	8.0		
Q	BMWW-l	MT20	5.0	8.0	2.50	3.75
R	BMWW-l	MT20	5.0	8.0	2.50	2.00
S	BMV1+p	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007042 32

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408133	T37	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 10:35:51 2020 Page 1
ID:DMCubINVR6TsiFos31v6l_2ns11-qZ2dwfW6se49lphbblu36Ds0911vKZnO2medzNDAs

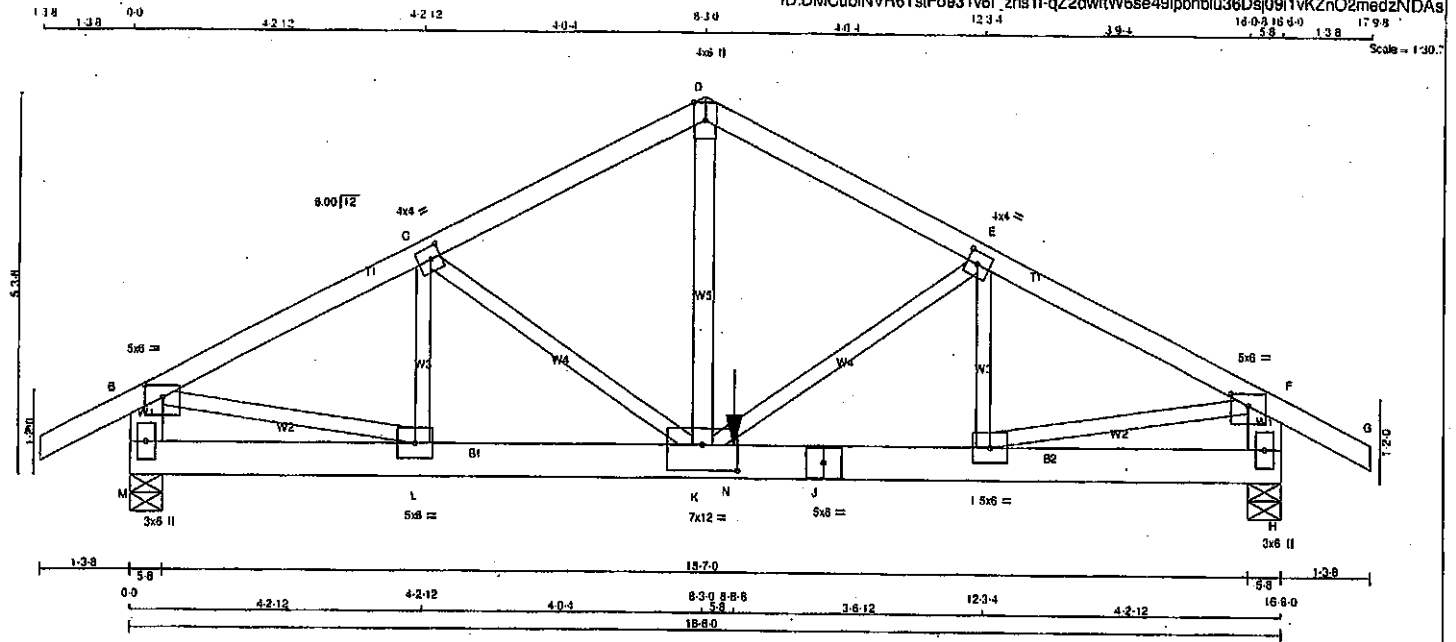

TOTAL WEIGHT = 2 X 79 = 158 lb (M)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
M - B	2x6	DRY	No.2	SPF	
H - F	2x6	DRY	No.2	SPF	
M - J	2x6	DRY	No.2	SPF	
J - H	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
K - D	2x4	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS	#ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS			
A - D	1	12	TOP
D - G	1	12	TOP
M - B	2	12	TOP
H - F	2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS			
M - J	2	12	SIDE(0.0)
J - H	2	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS			
2x3	1	8	
2x4	1	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.
TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.
SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REORD BRG
JT	VERT	HORZ	DOWN	HORZ
M	2447	0	0	5-8
H	2813	0	0	5-8

UNFACTORED REACTIONS	1ST LCASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
M	1733	1123 / 0
H	1851	1197 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO									
A - B	0 / 28	-91.8	-91.8	0.07 (1)	10.00	K - D	0 / 2959	0.28 (1)	
B - C	-3375 / 0	-91.8	-91.8	0.17 (1)	4.94	K - E	-150 / 0	0.03 (1)	
C - D	-3654 / 0	-91.8	-91.8	0.17 (1)	4.78	I - E	-301 / 0	0.03 (1)	
D - E	-3683 / 0	-91.8	-91.8	0.17 (1)	4.79	C - K	0 / 271	0.03 (1)	
E - F	-3758 / 0	-91.8	-91.8	0.17 (1)	4.72	L - G	-721 / 0	0.07 (1)	
F - G	0 / 28	-91.8	-91.8	0.07 (1)	10.00	B - L	0 / 3084	0.38 (1)	
M - B	-2354 / 0	0.0	0.0	0.08 (1)	7.81	I - F	0 / 3431	0.42 (1)	
H - F	-2580 / 0	0.0	0.0	0.09 (1)	7.81				
M - L	0 / 0	-18.5	-18.5	0.08 (1)	10.00				
L - K	0 / 3033	-18.5	-18.5	0.39 (1)	10.00				
K - N	0 / 3375	-18.5	-18.5	0.50 (1)	10.00				
N - J	0 / 3375	-18.5	-18.5	0.50 (1)	10.00				
J - I	0 / 3375	-18.5	-18.5	0.50 (1)	10.00				
I - H	0 / 0	-18.5	-18.5	0.03 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
N	8-8-8	-2992	-2992	---	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.55")
CALCULATED VERT. DEFL.(TL) = L/999 (0.10")

CSI: TC=0.17/1.00 (E-F:1), BC=0.50/1.00 (I-K:1), WB=0.42/1.00 (F-I:1), SS=0.93/1.00 (I-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PL)	(PL)	(PL)
	MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	818	354	1667	788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.84 (B) (INPUT = 0.90)
JSI METAL = 0.52 (J) (INPUT = 1.00)



Structural component only
DWG# T-2007043 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408133	T37	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 10:35:51 2020 Page 2
ID:DMCubINVR6TslFoe31v6l zns11-qZ2dwitW6se49lbbblu36Dsj09i1vKZnO2medzNDAs

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	2.00	3.00
C	TMWW-I	MT20	4.0	4.0	2.00	1.75
D	TTW-p	MT20	4.0	8.0	Edge	
E	TMWW-I	MT20	4.0	4.0	2.00	1.75
F	TMVW-p	MT20	5.0	8.0	2.00	3.00
H	BMV1-p	MT20	3.0	8.0		
I	BMWW-I	MT20	5.0	8.0		
J	BS-I	MT20	5.0	6.0		
K	BMWW-I	MT20	7.0	12.0	4.25	6.00
L	BMWW-I	MT20	5.0	6.0		
M	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.




Structural component only
DWG# T-2007043 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408133	T38	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:35:52 2020 Page 1
ID:OMCubINVR6TstFoe31v6f_zns1l-lmb787u8tAmxnvOnFIG7ckK0QQZ2mLJ72nKA3zNDAr

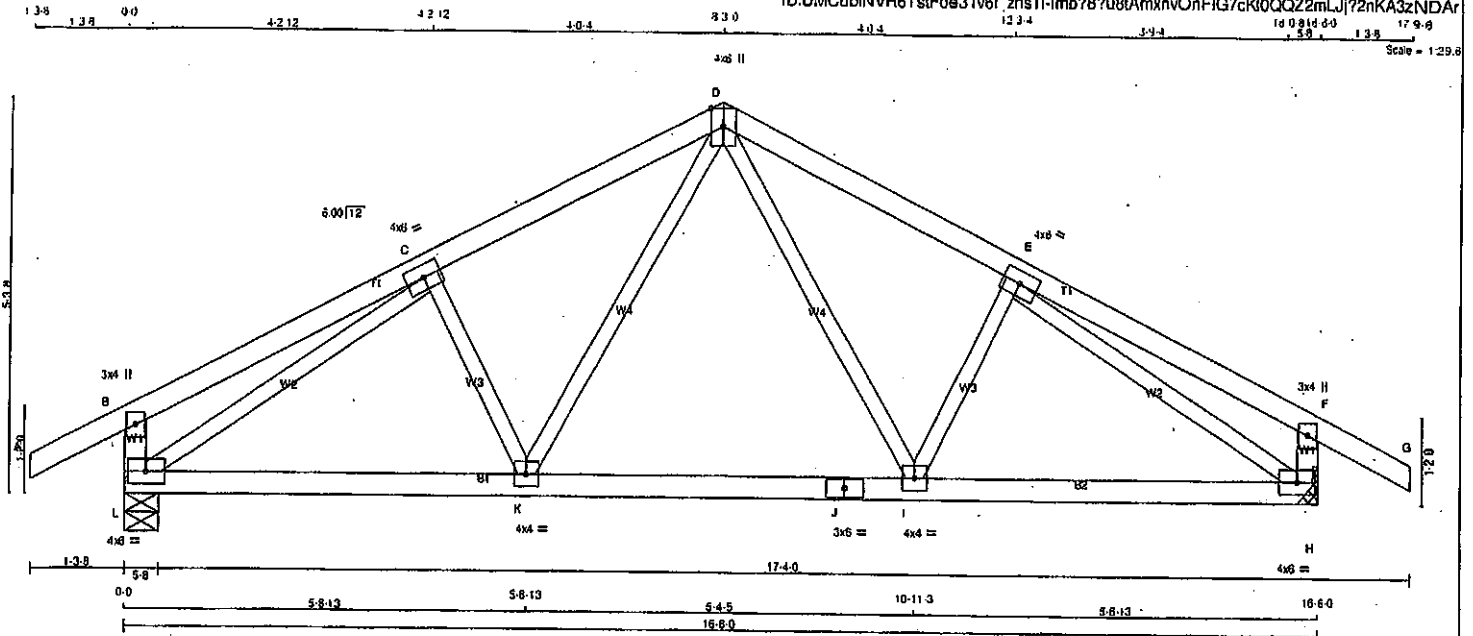

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
L - B	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (Table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMWW-i	MT20	4.0	6.0		
D TTWW+p	MT20	4.0	6.0	Edge	
E TMWW-i	MT20	4.0	6.0		
F TMV+p	MT20	3.0	4.0		
H BMWW-i	MT20	4.0	6.0		
I BMWW-i	MT20	4.0	4.0		
J BS-i	MT20	3.0	6.0		
K BMWW-i	MT20	4.0	4.0		
L BMWW-i	MT20	4.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
L	1034	0	1034	0
H	1034	0	1034	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	729	492 / 0	0 / 0	0 / 0	0 / 0	237 / 0	0 / 0	0 / 0
H	729	492 / 0	0 / 0	0 / 0	0 / 0	237 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.83 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	LC2 MAX	UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	LC1 MAX	LC2 MAX
FR-TO							FR-TO				
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	0-1	0 / 354	0.08 (1)			
B-C	0 / 19	-91.8	-91.8	0.24 (1)	10.00	I-E	-228 / 0	0.05 (1)			
C-D	-1044 / 0	-91.8	-91.8	0.20 (1)	5.93	K-D	0 / 354	0.08 (1)			
D-E	-1044 / 0	-91.8	-91.8	0.20 (1)	5.93	C-K	-228 / 0	0.05 (1)			
E-F	0 / 19	-91.8	-91.8	0.24 (1)	10.00	L-C	-1245 / 0	0.51 (1)			
F-G	0 / 28	-91.8	-91.8	0.12 (1)	10.00	E-H	-1245 / 0	0.51 (1)			
L-B	-271 / 0	0.0	0.0	0.03 (1)	7.81						
H-F	-271 / 0	0.0	0.0	0.03 (1)	7.81						
L-K	0 / 1016	-18.5	-18.5	0.23 (1)	10.00						
K-J	0 / 749	-18.5	-18.5	0.19 (4)	10.00						
J-I	0 / 749	-18.5	-18.5	0.19 (4)	10.00						
I-H	0 / 1016	-18.5	-18.5	0.23 (1)	10.00						

TOTAL WEIGHT = 2 X 68 = 133 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.55")
CALCULATED VERT. DEFL.(TL) = L/999 (0.06")

CSI: TC=0.24/1.00 (B-C:1), BC=0.23/1.00 (H-I:1), WB=0.51/1.00 (E-H:1), SSI=0.18/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618	354
	1687	788
	1987	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.76 (E) (INPUT = 0.90)
JSI METAL = 0.31 (E) (INPUT = 1.00)




Structural component only
DWG# T-2007044



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408133	T40	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:35:55 2020 Page 1
ID:DMCubINVR6TsiFoe31vbl_zns1f-lLH8m0x0A58WeN6MwRqgEyNW3dbLznX9h00_nOzNDAo

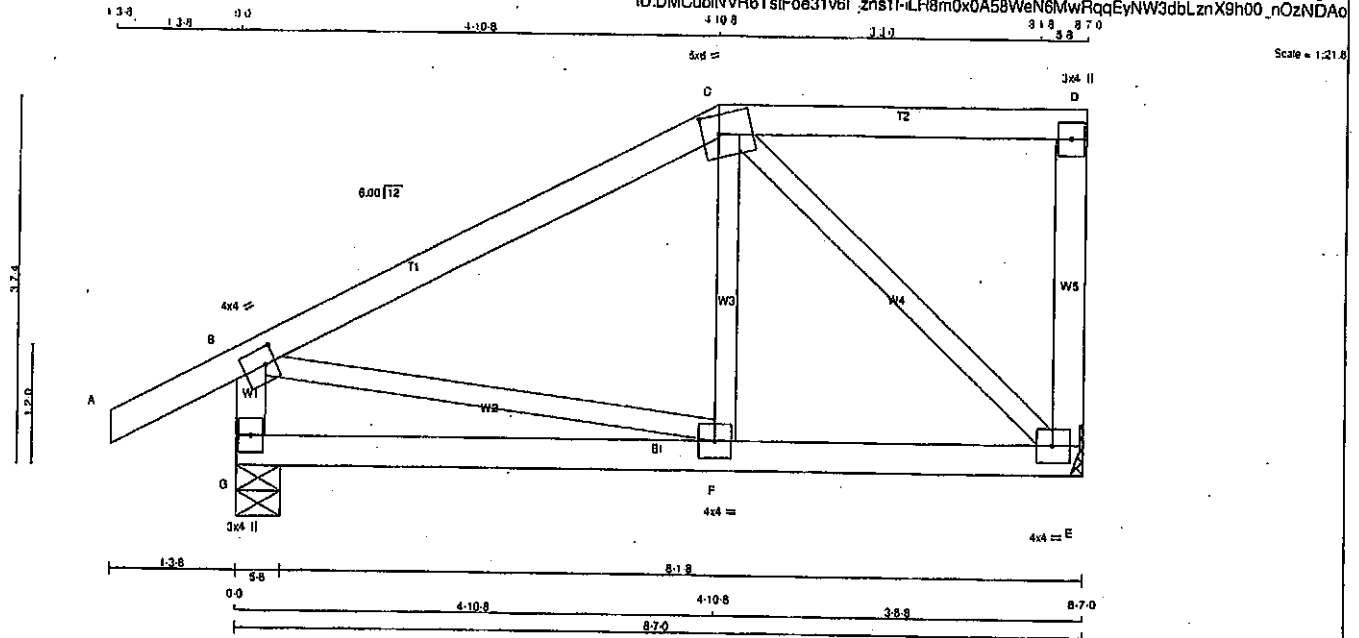

TOTAL WEIGHT = 36 lb
(M)(F)

LUMBER	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES				
CHORDS	SIZE	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
G - B	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE PLATES				
B TMVW-1	MT20	4.0	4.0	2.00 1.25
C TTVW-m	MT20	5.0	6.0	2.25 2.00
D TMV-p	MT20	3.0	4.0	
E BMVW-1	MT20	4.0	4.0	
F BMVW-1	MT20	4.0	4.0	
G BMV-1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
E	VERT 473 0	DOWN 473 0	UPLIFT 0 0	IN-SX 5-8
G	HORZ 598 0	HORZ 598 0	MECHANICAL	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS	1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE PERM.LIVE WIND DEAD SOIL
E	335	220 / 0	0 / 0 0 / 0 0 / 0 115 / 0 0 / 0
G	420	289 / 0	0 / 0 0 / 0 0 / 0 131 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 / 28	-91.8 -91.8 0.12 (1)	F-C	0 / 92
B-C	-350 / 0	-91.8 -91.8 0.28 (1)	C-E	-421 / 0
C-D	0 / 0	-91.8 -91.8 0.21 (1)	B-F	0 / 318
E-D	-170 / 0	0.0 0.0 0.03 (1)		
G-B	-559 / 0	0.0 0.0 0.08 (1)		
G-F	0 / 0	-18.5 -18.5 0.10 (4)		
F-E	0 / 315	-18.5 -18.5 0.13 (4)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.29")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.29")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.28/1.00 (B-C:1), BC=0.13/1.00 (E-F:4), WB=0.15/1.00 (C-E:1), SS=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 788	1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.57 (B) (INPUT = 0.90)
JSI METAL= 0.19 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007046

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408133	T41	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 10:35:56 2020 Page 1
ID:DMCubINVR6TstF0e31v6l_zns11-AXrWzMXsxOGNGWYU8L3mAwjT1wyEqIwglXJqzNDAn

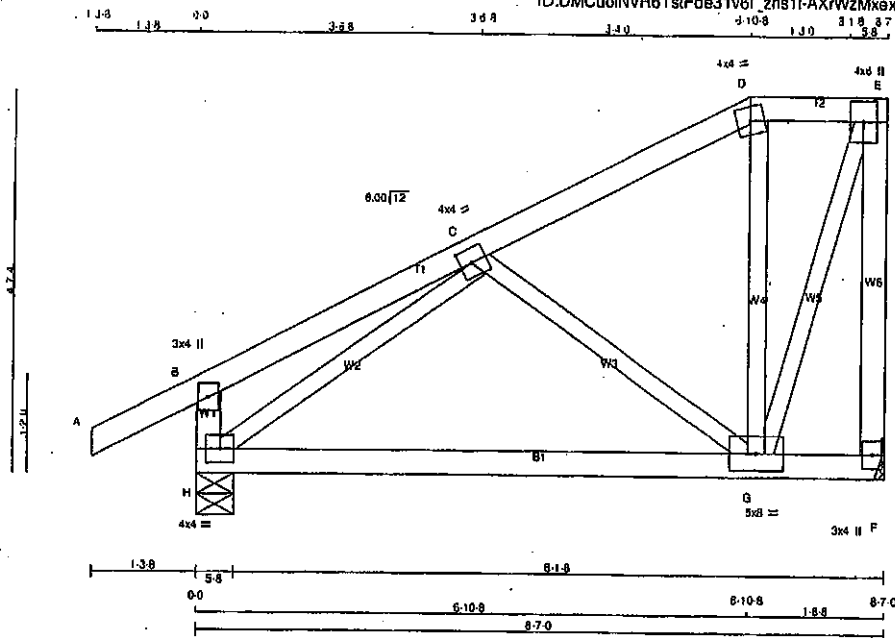

Scale = 1/20'

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
H - B	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0
C	TMVW+1	MT20	4.0	4.0
D	TTW-m	MT20	4.0	4.0
E	TMVW+p	MT20	4.0	6.0
F	BMV1+p	MT20	3.0	4.0
G	BMVW+1	MT20	5.0	8.0
H	BMVW1+1	MT20	4.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED	MAXIMUM FACTORED	INPUT	REQD	
	GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
F	473	0	473	0	0
H	598	0	598	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS							
JT	1ST LOASE	MAX/MIN	COMPONENT REACTIONS				
F	335	220 / 0	0 / 0	0 / 0	0 / 0	115 / 0	0 / 0
H	420	289 / 0	0 / 0	0 / 0	0 / 0	131 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO				FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	C-G	-292 / 0	0.09 (1)
B-C	0 / 16	-91.8	-91.8 0.17 (1)	10.00	G-D	-117 / 0	0.04 (1)
C-D	-189 / 0	-91.8	-91.8 0.13 (1)	6.25	G-E	0 / 460	0.10 (1)
D-E	-180 / 0	-91.8	-91.8 0.03 (1)	6.25	H-C	-498 / 0	0.15 (1)
F-E	-509 / 0	0.0	0.0 0.17 (1)	7.81			
H-B	-248 / 0	0.0	0.0 0.02 (1)	7.81			
H-G	0 / 399	-18.5	-18.5 0.23 (4)	10.00			
G-F	0 / 0	-18.5	-18.5 0.21 (4)	10.00			

TOTAL WEIGHT = 41 lb
(M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.29")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01")
ALLOWABLE DEFL. (TL) = $L/360$ (0.29")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.07")

CSI: TC=0.17/1.00 (B-C:1), BC=0.23/1.00 (G-H:4), WB=0.15/1.00 (C-H:1), SSI=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 Inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.46 (G) (INPUT = 0.90)
JSI METAL = 0.15 (H) (INPUT = 1.00)

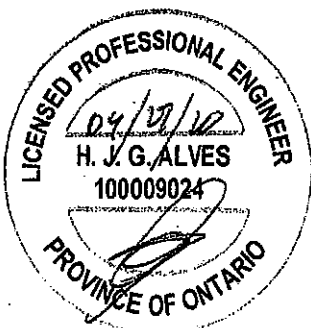

Structural component only
DWG# T-2007047

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408133	T42	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

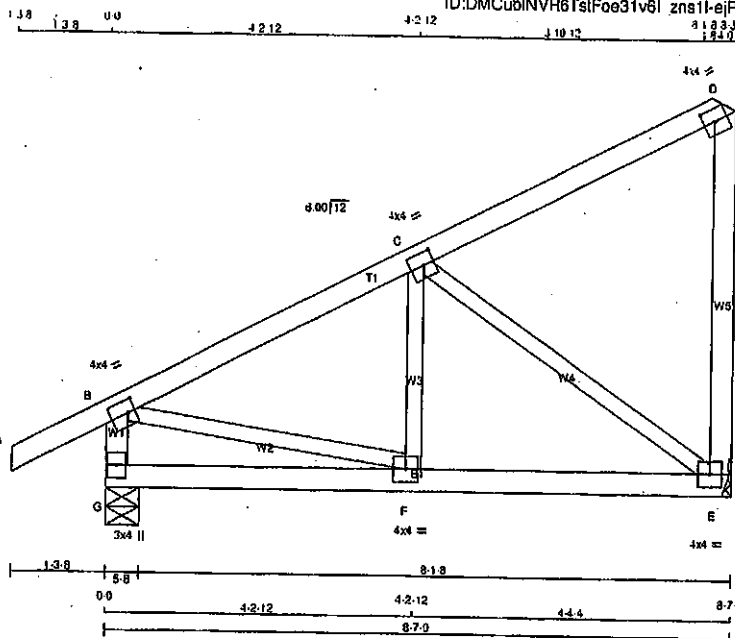

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
G - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
ALL WEBS EXCEPT E - D	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-1	MT20	4.0	4.0	2.00 1.25
C	TMVW-1	MT20	4.0	4.0	2.00 1.75
D	TMVW-1	MT20	4.0	4.0	2.00 1.75
E	BMVW-1	MT20	4.0	4.0	
F	BMVW-1	MT20	4.0	4.0	
G	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		INPUT		REQD	
JT	SPF	GROSS REACTION	MAXIMUM FACTORED	BRG	BRG	BRG	BRG
G	590	0	590	0	5-8	5-8	5-8
E	459	0	459	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX	MIN	COMPONENT REACTIONS
G	415	285/0	0/0	0/0 0/0 129/0 0/0
E	325	212/0	0/0	0/0 0/0 112/0 0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/28	-91.8 -91.8	0.12 (1)	10.00	F-C	0/80	0.03 (4)
B-C	-433/0	-91.8 -91.8	0.20 (1)	6.25	B-F	0/414	0.09 (1)
C-D	-23/0	-91.8 -91.8	0.20 (1)	6.25	E-D	-142/0	0.04 (1)
G-B	-558/0	0.0 0.0	0.06 (1)	7.81	C-E	-494/0	0.21 (1)
G-F	0/0	-18.5 -18.5	0.09 (4)	10.00			
F-E	0/408	-18.5 -18.5	0.12 (4)	10.00			

TOTAL WEIGHT = 38 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.25")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.28")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.20/1.00 (B-C:1), BC=0.12/1.00 (E-F:4), WB=0.21/1.00 (C-E:1), SS=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP=0.73 (B) (INPUT = 0.90)
JSI METAL=0.22 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007048

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408133	T43	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 10:35:59 2020 Page 1
ID:DMCubINVR6TstF0e31v6l_zns11-b6WecO_XDjX7_Q79HvmOoYApF_7vbAlce_Bw9zNDak

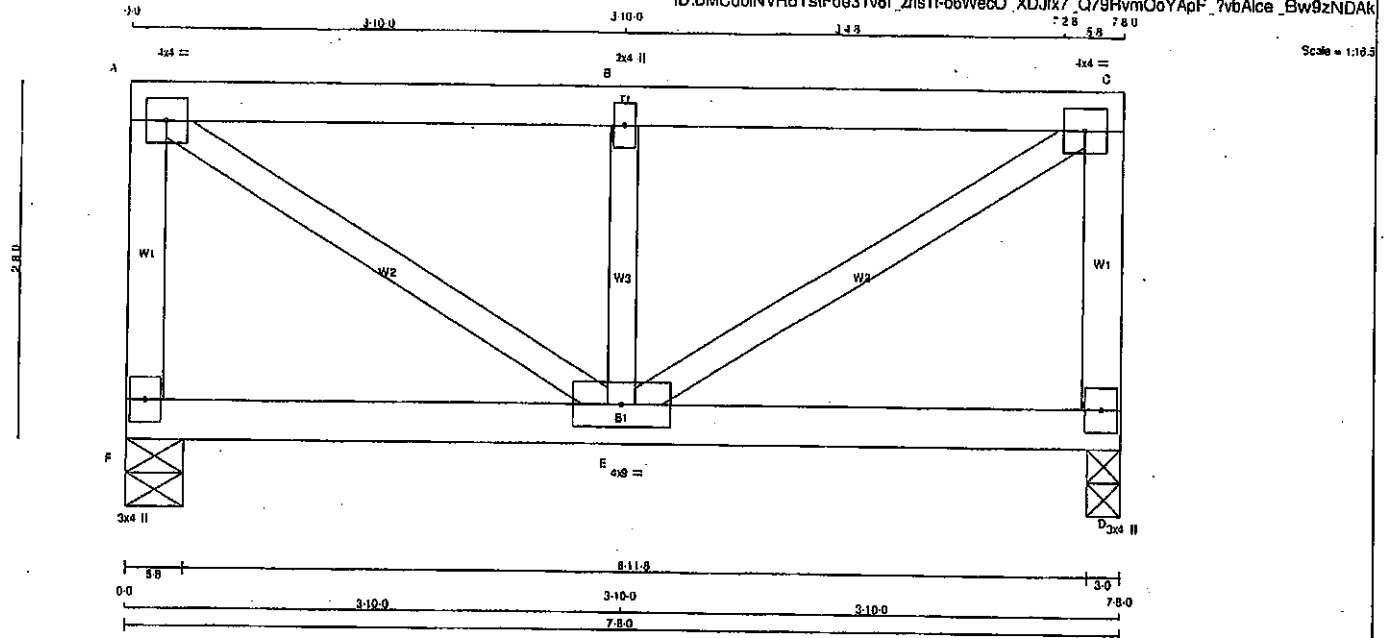

TOTAL WEIGHT = 30 k (MFR)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
F - A	2x4	DRY	No.2	SPF		
A - C	2x4	DRY	No.2	SPF		
D - C	2x4	DRY	No.2	SPF		
F - D	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
DRY: SEASONED LUMBER.						

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
A - TMVW-t	MT20	4.0	4.0			
B - TMVW-w	MT20	2.0	4.0			
C - TMVW-t	MT20	4.0	4.0			
D - BMV1+p	MT20	3.0	4.0			
E - BMVW-w-t	MT20	4.0	9.0			
F - BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
F	509	0	509	0	0	5-8	5-8
D	509	0	509	0	0	3-0	3-0

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT COMBINED							
F	368	196 / 0	0 / 0	0 / 0	0 / 0	172 / 0	0 / 0
D	368	196 / 0	0 / 0	0 / 0	0 / 0	172 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO									
F-A	-478 / 0	0.0	0.0	0.08 (1)	7.81	A-E	0 / 587	0.18 (1)	
A-B	-499 / 0	-114.3	-114.3	0.38 (1)	6.25	E-B	-538 / 0	0.12 (1)	
B-C	-499 / 0	-114.3	-114.3	0.38 (1)	6.25	E-C	0 / 587	0.18 (1)	
D-C	-478 / 0	0.0	0.0	0.08 (1)	7.81				
F-E	0 / 0	-18.5	-18.5	0.08 (4)	10.00				
E-D	0 / 0	-18.5	-18.5	0.08 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 15.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 48.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = 1/360 (0.28")
CALCULATED VERT. DEFL. (LL) = 1/999 (0.01")
ALLOWABLE DEFL. (TL) = 1/360 (0.28")
CALCULATED VERT. DEFL. (TL) = 1/999 (0.02")

CSI: TC=0.38/1.00 (A-B:1), BC=0.08/1.00 (E-F:4), WB=0.18/1.00 (A-E:1), SS=0.28/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION	(PSI)	(PLI)	(PLI)
MAX MIN MAX MIN MAX MIN			
MT20	618	354	1667 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.80 (A) (INPUT = 0.80)
JSI METAL = 0.25 (A) (INPUT = 1.00)



Structural component only
DWG# T-2007049

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 MiTek Industries, Inc. Sat Apr 25 10:35:45 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-?PgMgbpIW0uxRqRLRLKeUqzrznDhdIfhOSbSRzzNDAY



GABLE STUDS SPACED AT 2-0-0 OC.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER
PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: {4}

CHORDS				WEB S				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO		LENGTH	FR-TO			
J-A	-102 / 0	0.0	0.0	0.03 (1)	7.81	I-B	-242 / 0	0.05 (1)
A-B	-107 / 0	-114.3	-114.3	0.08 (1)	10.00	H-C	-229 / 0	0.05 (1)
B-C	-107 / 0	-114.3	-114.3	0.09 (1)	10.00	G-D	-218 / 0	0.05 (1)
C-D	-107 / 0	-114.3	-114.3	0.07 (1)	10.00			
D-E	-107 / 0	-114.3	-114.3	0.08 (1)	10.00			
E-F	-84 / 0	0.0	0.0	0.03 (1)	7.81			
J-I	0 / 10	-18.5	-18.5	0.02 (4)	10.00			
I-H	0 / 10	-18.5	-18.5	0.02 (4)	10.00			
H-G	0 / 10	-18.5	-18.5	0.02 (4)	10.00			
G-F	0 / 10	-18.5	-18.5	0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:				
TOP	CH.	LL	=	25.8 PSF
		DL	=	15.0 PSF
BOT	CH.	LL	=	0.0 PSF
		DL	=	7.4 PSF
TOTAL LOAD				= 48.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF 8CBC 2018 , OBC 2012 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.08/1.00 (B-C:1), BC=0.02/1.00 (I-J:4),
WB=0.05/1.00 (B-I:1), SSf=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PLI)		(PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	618	354	1667	788	1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)
JSI METAL= 0.07 (I) (INPUT = 1.00)




Structural component only
DWG# T-2007039

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408133	T44	4	1	TRUSS DESC.		

Tamareck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:36:00 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-3i41pk_9_dnok87Kj_Q?x04LWwJ8e2kurjITbzNDaj

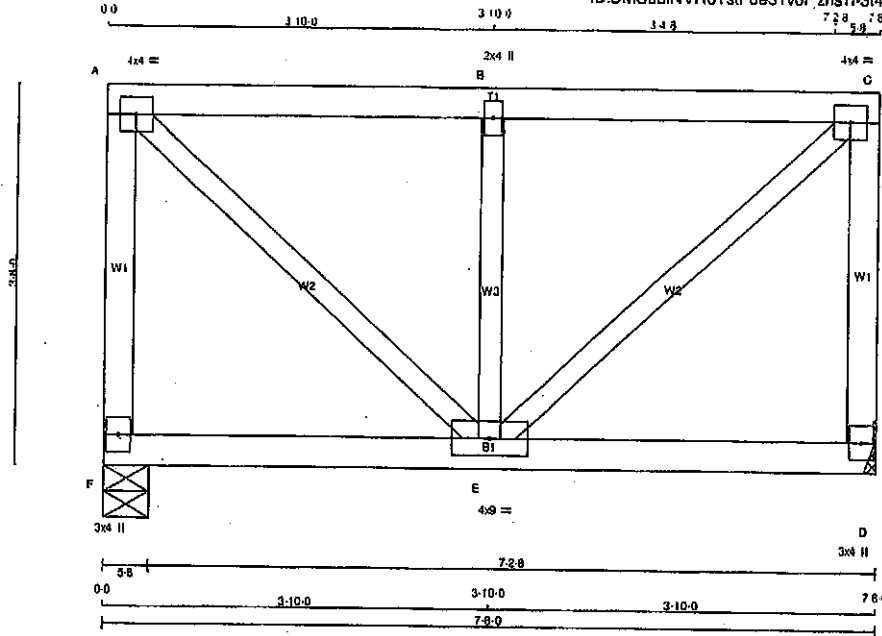

Scale = 1/21

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
F - A	2x4	DRY	No.2	SPF		
A - C	2x4	DRY	No.2	SPF		
D - C	2x4	DRY	No.2	SPF		
F - D	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
DRY: SEASONED LUMBER.						

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	4.0	4.0		
B	TMVW-1	MT20	2.0	4.0		
C	TMVW-1	MT20	4.0	4.0		
D	BMV1+p	MT20	3.0	4.0		
E	BMVWV-1	MT20	4.0	9.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER
PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING

FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	HORZ	DOWN	HORZ
F	509	0	509
D	509	0	509

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

UNFACTORED REACTIONS

1ST CASE	MAX./MIN.	COMPONENT REACTIONS
JT COMBINED	SNOW	LIVE
F	368	198 / 0
D	368	198 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRAC CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRAC CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
F-A	-479 / 0	0.0 0.0	0.13 (1)	7.81	A-E	0 / 471 0.14 (1)	
A-B	-354 / 0	-114.3 -114.3	0.38 (1)	6.25	E-B	-541 / 0 0.16 (1)	
B-C	-354 / 0	-114.3 -114.3	0.38 (1)	6.25	E-C	0 / 471 0.14 (1)	
D-C	-479 / 0	0.0 0.0	0.13 (1)	7.81			
F-E	0 / 0	-18.5 -18.5	0.09 (4)	10.00			
E-D	0 / 0	-18.5 -18.5	0.09 (4)	10.00			

TOTAL WEIGHT = 4 X 35 = 138 lb

DESIGN CRITERIA

SPECIFIED LOADS:	
TOP CH. LL	= 25.8 PSF
DL	= 15.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 48.0 PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2016, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.26")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.26")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.01")

CSI: TC=0.38/1.00 (B-C:1), BC=0.09/1.00 (E-F:4), WB=0.16/1.00 (B-E:1), SS=0.28/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1867 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.84 (C) (INPUT = 0.90)
JSI METAL = 0.16 (A) (INPUT = 1.00)



Structural component only
DWG# T-2007050

JOB NAME 408133	TRUSS NAME T45	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 10:36:01 2020 Page 1 ID:DMCubINVR6TstFoe31v6l_zns1l-XUeP047nkxvMiaWHhxETDdXc2cpNU114yTt?2zNDA		

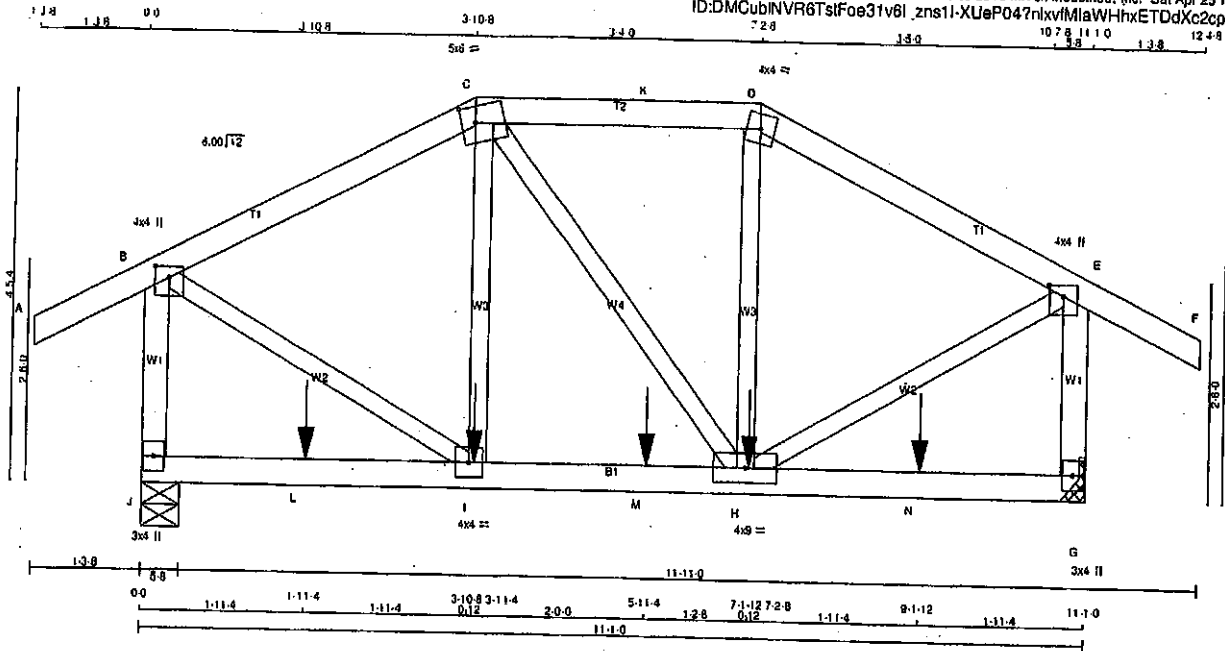

LUMBER			
N. L. G. A. RULES	SIZE	DRY	DESCR.
CHORDS	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
J - G	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY; SEASONED LUMBER.

PLATES (table in inches)			
JT TYPE	PLATES	W	LEN Y X
B	TMVW+p	MT20	4.0 4.0 1.50 2.00
C	TTW-m	MT20	5.0 6.0 2.25 2.00
D	TTW-m	MT20	4.0 4.0
E	TMVW+p	MT20	4.0 4.0 1.50 2.00
G	BMV1+p	MT20	3.0 4.0
H	BMVW-t	MT20	4.0 9.0
I	BMVW-t	MT20	4.0 4.0
J	BMV1+p	MT20	3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT REQRD BRG
JT	VERT	DOWN	BRG
J	1205 0	1205 0	5-8 IN-SX
G	1218 0	1218 0	5-8 MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
J	845	592 / 0	0 / 0	0 / 0	253 / 0	0 / 0
G	855	599 / 0	0 / 0	0 / 0	256 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)
FR-TO			
A-B	0 / 28	-91.8 -91.8 0.13 (1)	10.00
B-C	-844 / 0	-91.8 -91.8 0.28 (1)	6.24
C-K	-771 / 0	-91.8 -91.8 0.20 (1)	8.25
K-D	-771 / 0	-91.8 -91.8 0.20 (1)	8.25
D-E	-861 / 0	-91.8 -91.8 0.28 (1)	6.20
E-F	0 / 28	-91.8 -91.8 0.13 (1)	10.00
J-B	-1096 / 0	0.0 0.0 0.15 (1)	7.52
G-E	-1112 / 0	0.0 0.0 0.16 (1)	7.48
J-L	0 / 0	-18.5 -18.5 0.26 (1)	10.00
L-I	0 / 0	-18.5 -18.5 0.26 (1)	10.00
I-M	0 / 755	-18.5 -18.5 0.32 (1)	10.00
M-H	0 / 755	-18.5 -18.5 0.32 (1)	10.00
H-N	0 / 0	-18.5 -18.5 0.25 (1)	10.00
N-G	0 / 0	-18.5 -18.5 0.25 (1)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
J	7-1-12	-187	-187	---	BACK	VERT	TOTAL	---	C1
I	3-11-4	-187	-187	---	BACK	VERT	TOTAL	---	C1
L	1-11-4	-195	-195	---	BACK	VERT	TOTAL	---	C1
M	5-11-4	-187	-187	---	BACK	VERT	TOTAL	---	C1
N	9-1-12	-195	-195	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 51 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.37")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.37")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.05")

CSI: TC=0.28/1.00 (D-E:1), BC=0.32/1.00 (H-I:1), WB=0.22/1.00 (E-H:1), SS=0.14/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (I) (INPUT = 0.90)
JSI METAL = 0.28 (I) (INPUT = 1.00)



Structural component only
DWG# T-2007051

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408133	T46	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:38:02 2020 Page 1
ID:DMCubINVR6tFoe31v6l_zns1l-?hCnEP0PWE1W_R9kPSTORAivs_U6zFBibCsXUzNDah

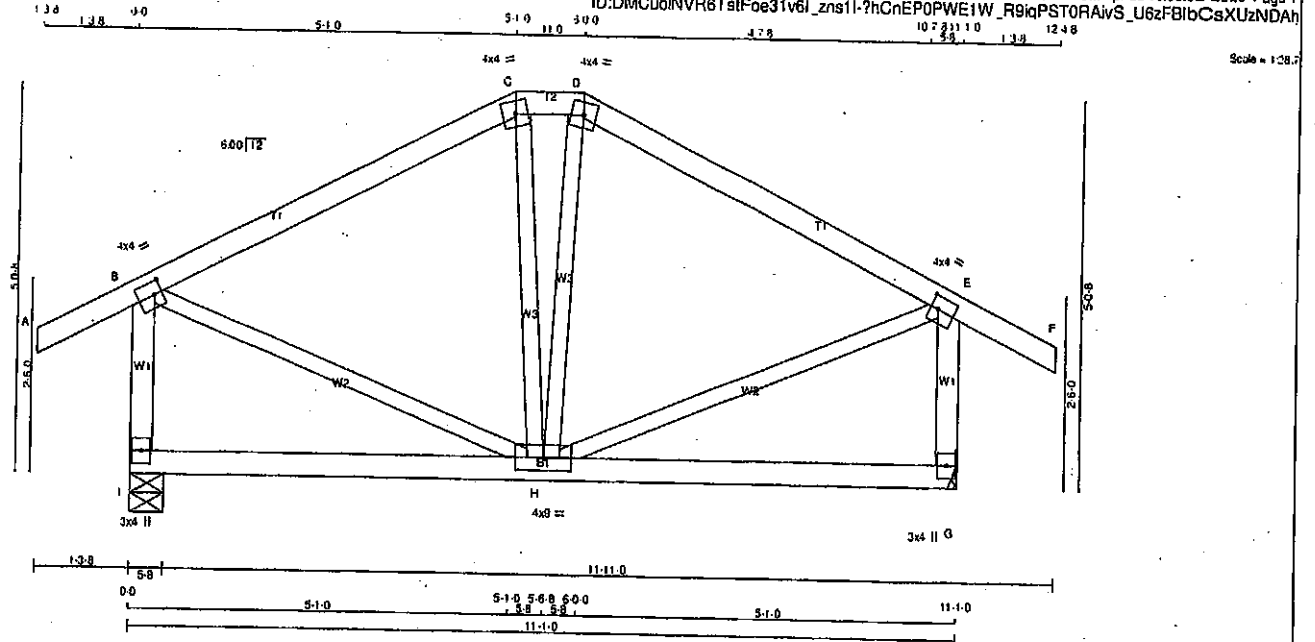

TOTAL WEIGHT = 51 lb
(MIF)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - D	2x4	DRY	No.2	SPF		
D - F	2x4	DRY	No.2	SPF		
I - B	2x4	DRY	No.2	SPF		
G - E	2x4	DRY	No.2	SPF		
I - G	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	4.0	2.00	1.25
C	TTW-m	MT20	4.0	4.0		
D	TTW-m	MT20	4.0	4.0		
E	TMVW-1	MT20	4.0	4.0	2.00	1.25
G	BMV1+p	MT20	3.0	4.0		
H	BMVWVW-1	MT20	4.0	9.0		
I	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORIZ	UPLIFT
I	735	0	0	5-8
G	735	0	0	5-8
			MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 1-8.

UNFACTORED REACTIONS

1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED					
I	518	353 / 0	0 / 0	0 / 0	185 / 0	0 / 0
G	518	353 / 0	0 / 0	0 / 0	185 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORIZ. LOAD (LBS)	MAX. FACTORED TORSION (LBS-FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED TORSION (LBS-FT)
FR-TO						FR-TO			
A-B	0 / 28					B-H	0 / 405	0.09 (1)	
B-C	-422 / 0	-91.8	-91.8	0.31 (1)	10.00	H-E	0 / 405	0.09 (1)	
C-D	-369 / 0	-91.8	-91.8	0.01 (1)	6.25	C-H	-88 / 18	0.03 (1)	
D-E	-422 / 0	-91.8	-91.8	0.31 (1)	6.25	H-D	-88 / 18	0.03 (1)	
E-F	0 / 28								
I-B	-888 / 0	0.0	0.0	0.09 (1)	7.81				
G-E	-888 / 0	0.0	0.0	0.09 (1)	7.81				
I-H	0 / 0	-18.5	-18.5	0.18 (4)	10.00				
H-G	0 / 0	-18.5	-18.5	0.18 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.37")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.37")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.31/1.00 (D-E:1), BC=0.16/1.00 (G-H:4), WB=0.09/1.00 (B-H:1), SS=0.16/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (E) (INPUT = 0.90)
JSI METAL = 0.22 (E) (INPUT = 1.00)

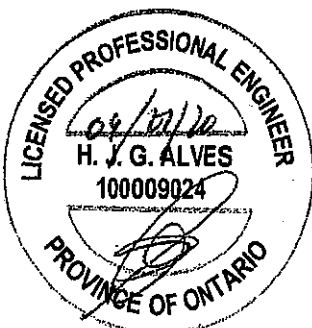

Structural component only
DWG# T-2007052

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408133	T47S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

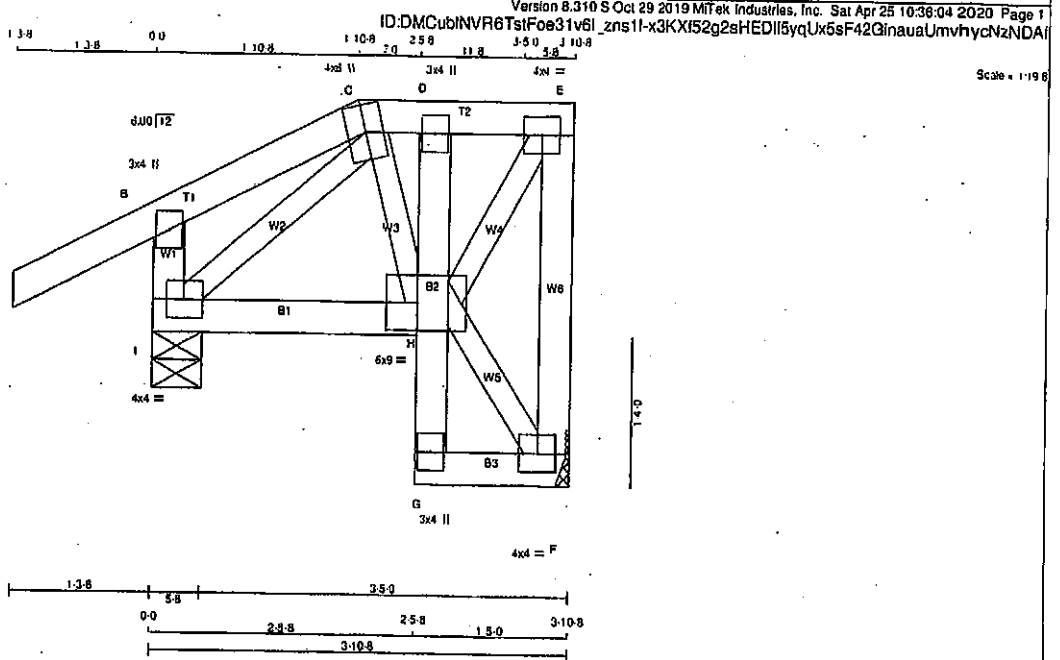

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DESCR
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2
H - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
SPF			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TTWw+m	MT20	4.0	6.0	
D	TMV+p	MT20	3.0	4.0	
E	TMVW-I	MT20	4.0	4.0	
F	BMVW-I	MT20	4.0	4.0	
G	BMV+p	MT20	3.0	4.0	
H	BMVW/I	MT20	6.0	9.0	3.00 3.50
I	BMVW-I	MT20	4.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS									
FACTORED					MAXIMUM FACTORED				
GROSS REACTION					GROSS REACTION				
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	MECHANICAL	
F	214	0	214	0	0	5-8	5-8		
I	338	0	338	0	0				

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

1ST CASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	151	99/0	0/0	0/0	0/0	52/0	0/0
I	237	169/0	0/0	0/0	0/0	68/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/28	-91.8 -91.8 0.14 (5)	10.00	C-H	-13/7	0.00 (4)	
B-C	0/0	-91.8 -91.8 0.06 (1)	10.00	H-F	-8/0	0.00 (1)	
C-D	-103/0	-91.8 -91.8 0.01 (1)	6.25	I-C	-148/0	0.03 (1)	
D-E	-99/0	-91.8 -91.8 0.02 (1)	6.25	H-E	0/172	0.04 (1)	
E-F	-196/0	0.0 0.0 0.04 (1)	7.81				
F-B	-212/0	0.0 0.0 0.02 (1)	7.81				
I-H	0/107	-18.5 -18.5 0.04 (4)	10.00				
G-H	0/13	0.0 0.0 0.01 (1)	10.00				
H-D	-98/0	0.0 0.0 0.01 (1)	7.81				
G-F	0/5	-18.5 -18.5 0.01 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 24 = 48 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (A-B:5), BC=0.04/1.00 (H-I:4), WB=0.04/1.00 (E-H:1), SS=0.10/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (H) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)

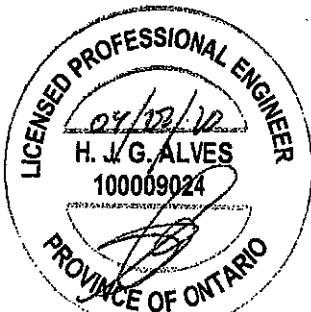


Structural component only
DWG# T-2007053

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408133	T50	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			


Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:38:05 2020 Page 2
ID:DMCubINVR6TslFoe31v6l zns1l-PGuwsR2lp9P5vrlHWX7Ae3oA IvYJF6d?ZRW8pzND Ae

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
C	TTW-m	MT20	4.0	4.0		
D	TMVW+p	MT20	4.0	6.0		
E	BMV1+p	MT20	3.0	6.0		
F	BMWW-t	MT20	6.0	9.0		
G	BMWW-t	MT20	5.0	6.0		
H	BMV1+p	MT20	3.0	6.0		

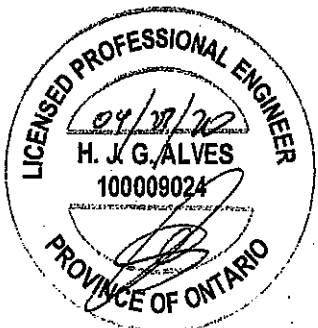

Structural component only
DWG# T-2007054 2/2

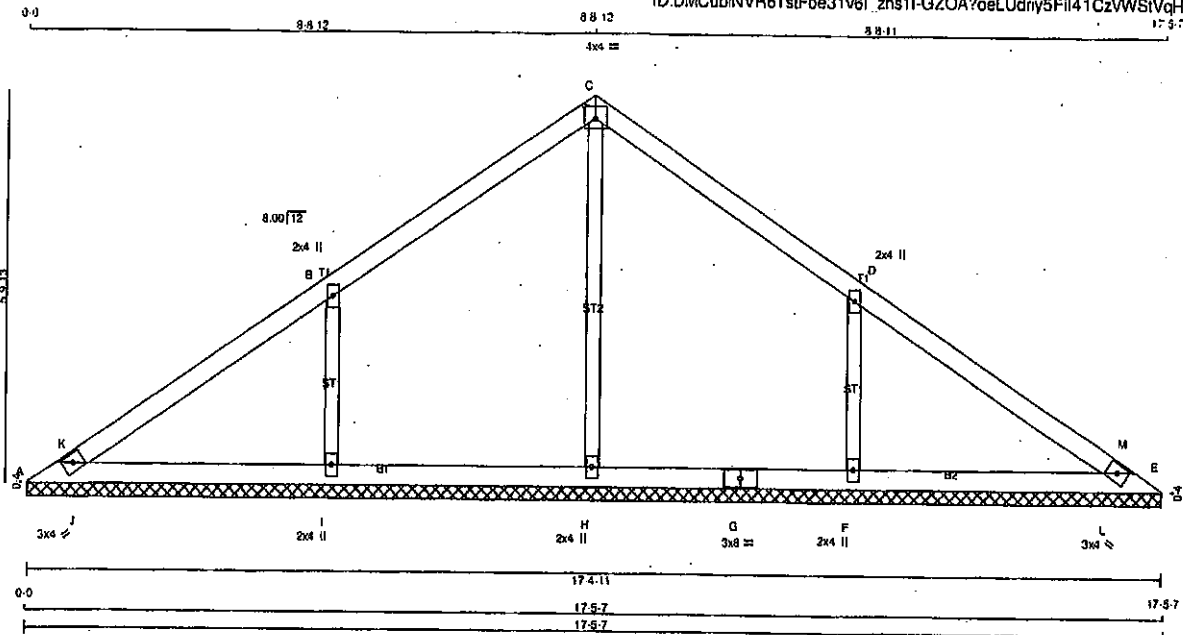

Scale = 1:32.5

TOTAL WEIGHT = 51 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
A - G	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
A TBM1-h	MT20	3.0	4.0		
B TMW-w	MT20	2.0	4.0		
C TTW-p	MT20	4.0	4.0	2.25	2.00
D TMW-w	MT20	2.0	4.0		
E TBM1-h	MT20	3.0	4.0		
F, H, I					
F BMW1-w	MT20	2.0	4.0		
G BS-1	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
A	137	0	137	0	17-4-11 (6-4-15/14-11)	
E	137	0	137	0	17-4-11 (6-4-15/14-11)	
H	482	0	482	0	17-4-11 (6-4-15/14-11)	
I	580	0	580	0	17-4-11 (6-4-15/14-11)	
F	580	0	580	0	17-4-11 (6-4-15/14-11)	

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS				
		SNOW	LIVE	PERM. LIVE	WIND	DEAD
A	97	66/0	0/0	0/0	0/0	30/0
E	97	66/0	0/0	0/0	0/0	30/0
H	344	211/0	0/0	0/0	0/0	133/0
I	410	273/0	0/0	0/0	0/0	137/0
F	410	273/0	0/0	0/0	0/0	137/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, H, I, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		UNBRAC LENGTH	FR-TO		
A-K	0/109	-91.8	-91.8 0.05 (4)	10.00	H-C	-439/0 0.22 (1)	
K-B	0/156	-91.8	-91.8 0.28 (1)	10.00	I-B	-453/0 0.08 (1)	
B-C	0/116	-91.8	-91.8 0.28 (1)	10.00	F-D	-453/0 0.08 (1)	
C-D	0/116	-91.8	-91.8 0.28 (1)	10.00	J-K	-122/6 0.00 (1)	
D-M	0/156	-91.8	-91.8 0.28 (1)	10.00	L-M	-122/6 0.00 (1)	
M-E	0/109	-91.8	-91.8 0.05 (4)	10.00			
A-J	-126/0	-18.5	-18.5 0.12 (1)	6.25			
J-I	-105/0	-18.5	-18.5 0.12 (1)	6.25			
I-H	-118/0	-18.5	-18.5 0.09 (1)	6.25			
H-G	-118/0	-18.5	-18.5 0.09 (1)	6.25			
G-F	-118/0	-18.5	-18.5 0.09 (1)	6.25			
F-L	-105/0	-18.5	-18.5 0.12 (1)	6.25			
L-E	-126/0	-18.5	-18.5 0.12 (1)	6.25			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2010, NBCO 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBCO 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.28/1.00 (B-K:1), BC=0.12/1.00 (I-J:1), WB=0.22/1.00 (C-H:1), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN MAX MIN MAX MIN		
MT20	618 354 1667 788 1987 1856	

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.40 (D) (INPUT = 0.90)
JSI METAL = 0.23 (B) (INPUT = 1.00)



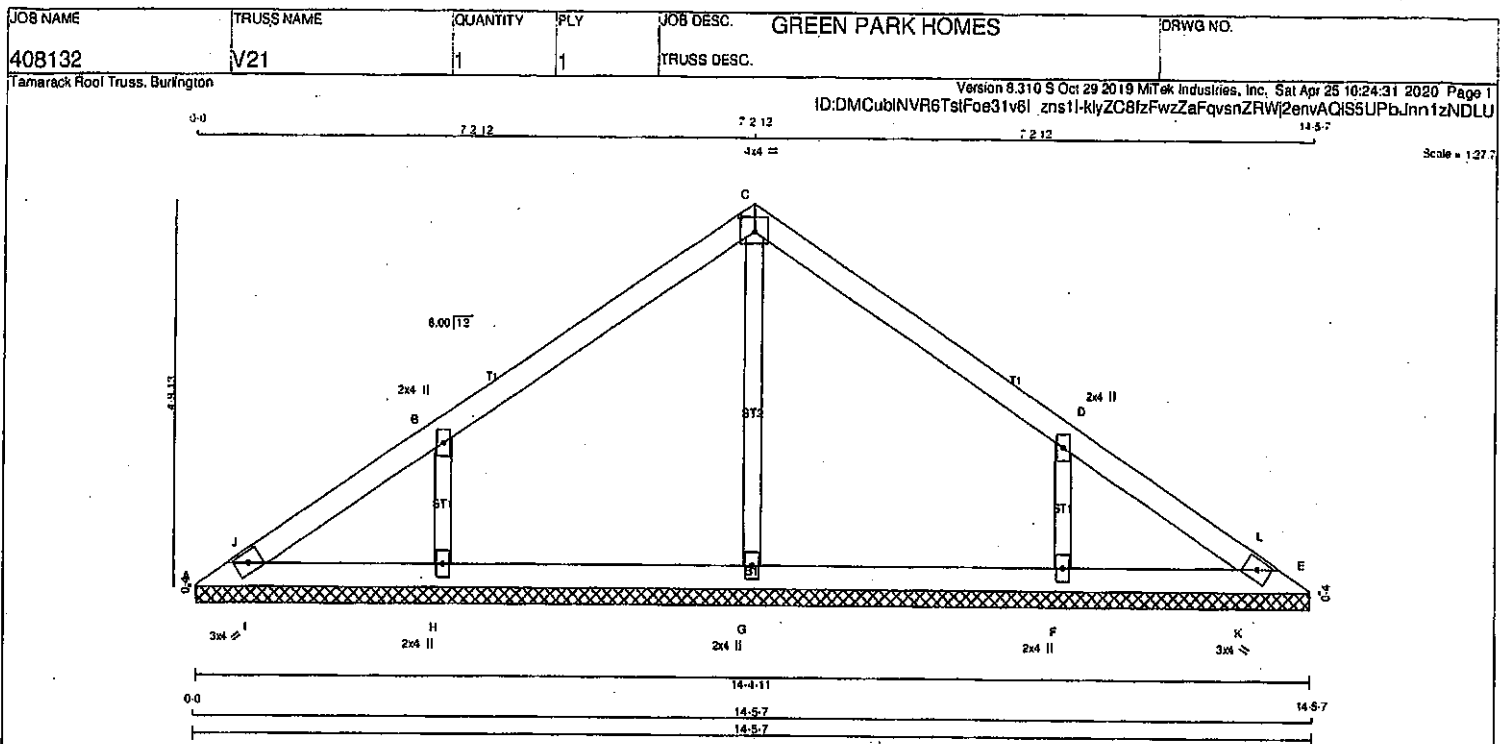

TOTAL WEIGHT = 41 lb

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
A - E	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B	TMW-w	MT20	2.0	4.0		
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TMW-w	MT20	2.0	4.0		
E	TBM1-h	MT20	3.0	4.0		
F, G, H	BMW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
A	128	0	128	0	14-4-11	14-4-11
E	128	0	128	0	14-4-11	14-4-11
G	381	0	381	0	14-4-11	14-4-11
H	485	0	485	0	14-4-11	14-4-11
F	485	0	485	0	14-4-11	14-4-11

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX. MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	90	82/0	0/0	0/0	0/0	28/0	0/0
E	90	82/0	0/0	0/0	0/0	28/0	0/0
G	259	153/0	0/0	0/0	0/0	105/0	0/0
H	342	230/0	0/0	0/0	0/0	112/0	0/0
F	342	230/0	0/0	0/0	0/0	112/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, G, H, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

FR-TO	CHORDS			UNBRACED LENGTH	FR-TO	WEBS		
	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)			MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
A-J	-44/0	-91.8	-91.8	0.04 (1)	6.25	G-C	-292/0	0.10 (1)
J-B	0/15	-91.8	-91.8	0.21 (1)	10.00	H-B	-399/0	0.08 (1)
B-C	-28/4	-91.8	-91.8	0.21 (1)	6.25	F-D	-399/0	0.08 (1)
C-D	-28/4	-91.8	-91.8	0.21 (1)	6.25	I-J	-28/7	0.00 (1)
D-L	0/15	-91.8	-91.8	0.21 (1)	10.00	K-L	-28/7	0.00 (1)
L-E	-44/0	-91.8	-91.8	0.04 (1)	6.25			
A-I	-5/18	-18.5	-18.5	0.04 (1)	10.00			
I-H	-3/24	-18.5	-18.5	0.05 (4)	10.00			
H-G	-7/6	-18.5	-18.5	0.08 (4)	10.00			
G-F	-7/6	-18.5	-18.5	0.08 (4)	10.00			
F-K	-3/24	-18.5	-18.5	0.05 (4)	10.00			
K-E	-5/18	-18.5	-18.5	0.04 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.21/1.00 (B-J-1), BC=0.08/1.00 (G-H-4), WB=0.10/1.00 (C-G-1), SS=0.15/1.00 (B-C-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PS) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.27 (D) (INPUT = 0.90)
JSI METAL = 0.20 (B) (INPUT = 1.00)

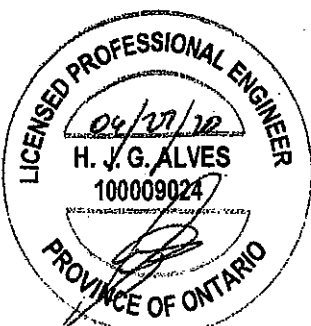

Structural component only
DWG# T-2007034

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408132	V22	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

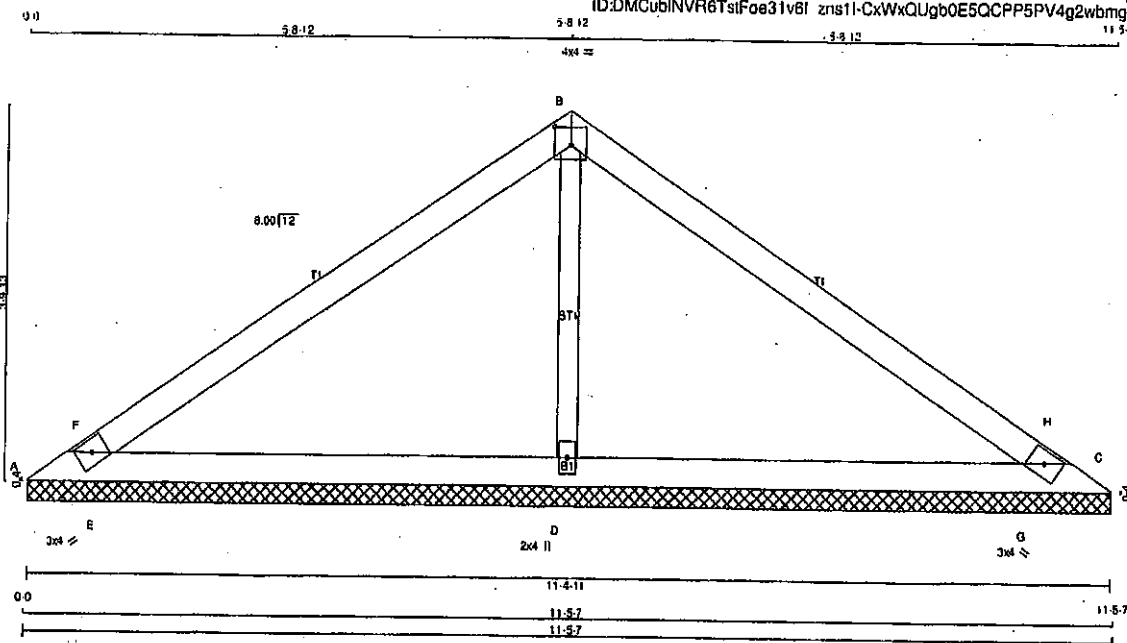

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
A - C	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TBM1-h	MT20	3.0	4.0
B	TTW-p	MT20	4.0	4.0 2.25 2.00
C	TBM1-h	MT20	3.0	4.0
D	BMW1-w	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
A	-11	0	0	0	-11	11-4-11	11-4-11	
C	-11	0	0	0	-11	11-4-11	11-4-11	
D	1277	0	1277	0	0	11-4-11	11-4-11	

PROVIDE ANCHORAGE AT BEARING JOINT A FOR 150 LBS FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST CASE	MAX MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	-7	0/-7	0/0	0/0	0/0	0/0	0/0	0/0
C	-7	0/-7	0/0	0/0	0/0	0/0	0/0	0/0
D	902	597/0	0/0	0/0	0/0	0/0	305/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. FACTORED UNBRACED LENGTH FR-TO	MAX. FACTORED FORCE (LBS)
A-F	0/591	-91.8 -91.8 0.25 (1)	10.00	D-B -1043/0
F-B	0/584	-91.8 -91.8 0.39 (1)	10.00	E-F -332/0
B-H	0/584	-91.8 -91.8 0.39 (1)	10.00	G-H -332/0
H-C	0/591	-91.8 -91.8 0.25 (1)	10.00	
A-E	-528/0	-18.5 -18.5 0.25 (1)	8.25	
E-D	-480/0	-18.5 -18.5 0.25 (1)	8.25	
D-G	-480/0	-18.5 -18.5 0.25 (1)	8.25	
G-C	-528/0	-18.5 -18.5 0.25 (1)	8.25	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.39/1.00 (B-F:1), BC=0.25/1.00 (D-E:1),
WB=0.23/1.00 (B-D:1), SS=0.18/1.00 (A-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (B) (INPUT = 0.90)
JSI METAL = 0.30 (B) (INPUT = 1.00)

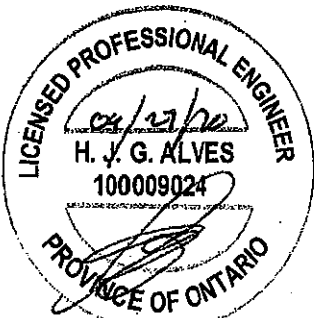

Structural component only
DWG# T-2007035

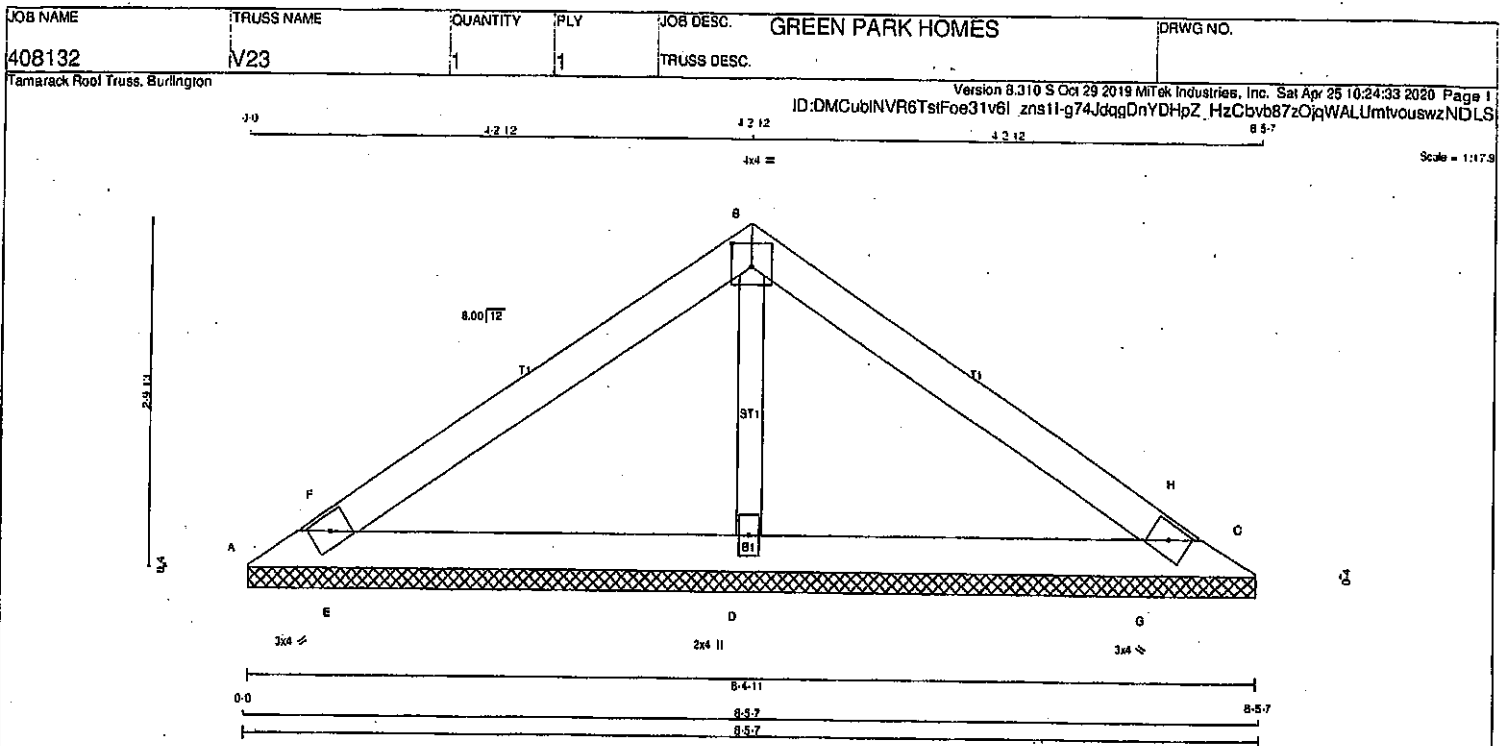

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	No.2	DESCR.	SPF
A - B	2x4	DRY	No.2	SPF	
B - C	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B	TTW-p	MT20	4.0	4.0	2.25	2.00
C	TBM1-h	MT20	3.0	4.0		
D	BMW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
A	58	0	58	0	8-4-11	8-4-11
C	58	0	58	0	8-4-11	8-4-11
D	808	0	808	0	8-4-11	8-4-11

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX/MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	41	27/0	0/0	0/0	0/0	14/0	0/0
C	41	27/0	0/0	0/0	0/0	14/0	0/0
D	572	375/0	0/0	0/0	0/0	198/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-F	0/297	-91.8 -91.8 0.10 (1)	10.00	D-B	-623/0	0.10 (1)	
F-B	0/294	-91.8 -91.8 0.20 (1)	10.00	E-F	-202/0	0.00 (1)	
B-H	0/294	-91.8 -91.8 0.20 (1)	10.00	G-H	-202/0	0.00 (1)	
H-C	0/297	-91.8 -91.8 0.10 (1)	10.00				
A-E	-278/0	-18.5 -18.5 0.15 (1)	6.25				
E-D	-250/0	-18.5 -18.5 0.15 (1)	6.25				
D-G	-250/0	-18.5 -18.5 0.15 (1)	6.25				
G-C	-278/0	-18.5 -18.5 0.15 (1)	6.25				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	DL	PSF
	25.6	6.0	PSF

BOT CH.	LL	DL	PSF
	0.0	7.4	PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.20/1.00 (B-F:1), BC=0.15/1.00 (D-E:1), WB=0.10/1.00 (B-D:1), SS=0.11/1.00 (A-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MT20	618	354	1687 788 1887 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.52 (B) (INPUT = 0.80)
JSI METAL = 0.18 (B) (INPUT = 1.00)

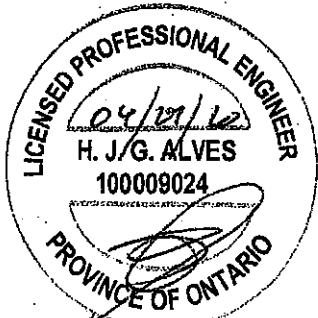


Structural component only
DWG# T-2007036

JOB NAME 408087	TRUSS NAME J1	QUANTITY 21	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	------------------	----------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Sat Apr 28 08:53:11 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns11-BUqu4KKZocY685uhquEMP543auqFK1_IH0soSgzNEh6

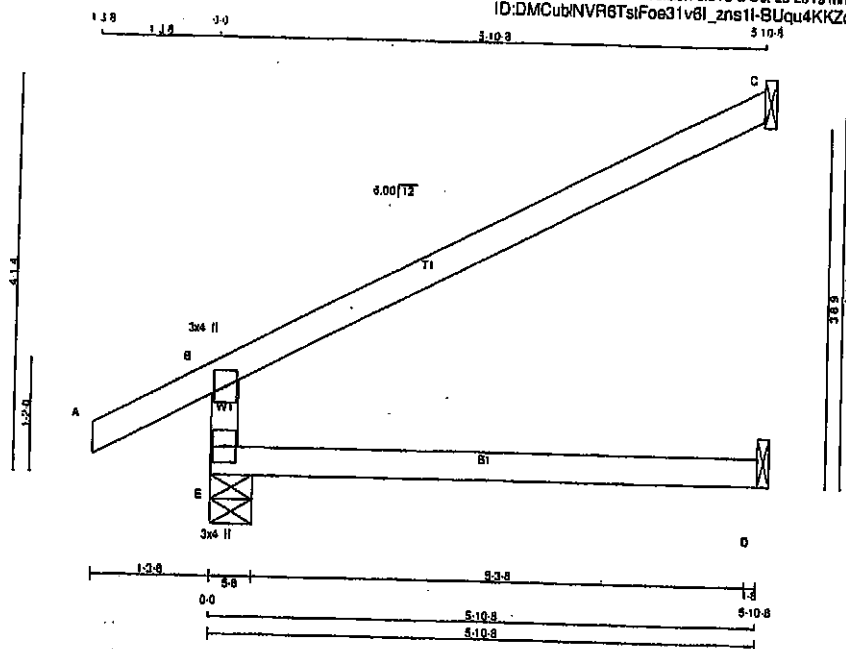

Scale = 1/2" = 1'-0"

LUMBER			
N.L.G.A. RULES	SIZE	LUMBER	
CHORDS			
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	525	0	525	0	0	5-8	5-8
C	202	0	202	0	0	1-8	1-8
D	45	0	50	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	389	257/0	0/0	0/0	0/0	111/0	0/0
C	139	113/0	0/0	0/0	0/0	28/0	0/0
D	38	0/0	0/0	0/0	0/0	38/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
E-B	-461/0	0.0	0.0 0.13 (4)	7.81	
A-B	0/28	-91.8	-91.8 0.12 (1)	10.00	
B-C	-30/0	-91.8	-91.8 0.64 (1)	6.25	
E-D	0/0	-18.5	-18.5 0.13 (4)	10.00	

TOTAL WEIGHT = 21 X 17 = 353 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/889 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/889 (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.24/1.00 (B-C:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (E) (INPUT = 0.90)
JSI METAL = 0.13 (B) (INPUT = 1.00)

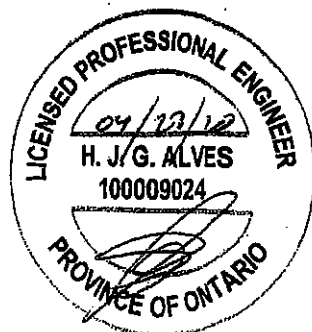


Structural component only
DWG# T-20006924

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408131	J2	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 MITek Industries, Inc. Sat Apr 25 10:07:18 2020 Page 1
ID:DMCubINVR6TstFoe31v6L_zns1l-U012Pw9?WXq88VMNRKWB8tm85VcPAGIQINbd1PzNDbd

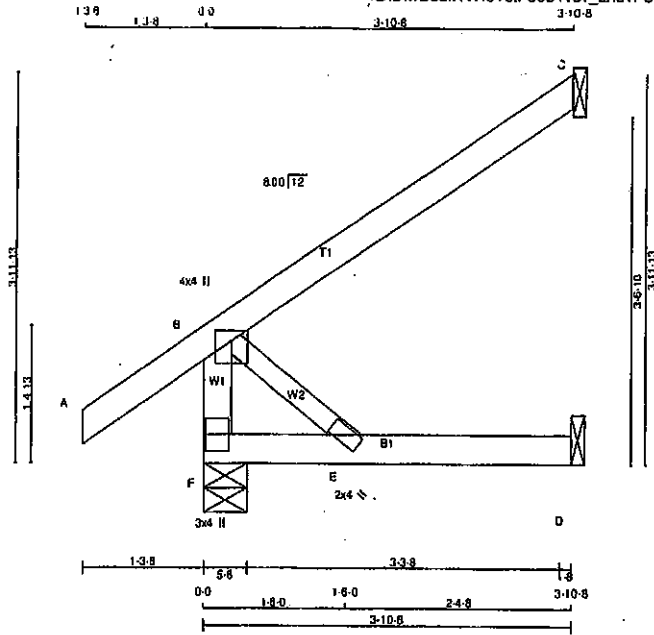

TOTAL WEIGHT = 4 X 14 = 57 lb (M)

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	SPF	
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMW+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	IN-SX
F	340	0	340	0	0	5-8	5-8		
C	178	0	178	0	0	1-8	1-8		
D	38	0	40	0	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
	1ST CASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	238	169/0	0/0	0/0	0/0	88/0	0/0
C	122	99/0	0/0	0/0	0/0	23/0	0/0
D	28	0/0	0/0	0/0	0/0	29/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS		FACTORED		W E B S		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)	MAX. FACTORED	CSI (LC)
FR-TO		FROM	TO	FR-TO			
F-B	-304/0	0.0	0.0 0.03 (1)	8-E	0/0	0.00 (1)	
A-B	0/35	-91.8	-91.8 0.14 (5)				
B-C	0/0	-91.8	-91.8 0.23 (1)				
F-E	0/0	-18.5	-18.5 0.08 (4)				
E-D	0/0	-18.5	-18.5 0.08 (4)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/899 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/899 (0.01")

CSI: TC=0.23/1.00 (B-C:1), BC=0.08/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.21 (B) (INPUT= 0.90)
JSI METAL= 0.08 (B) (INPUT= 1.00)




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408131	J3	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:07:20 2020 Page 1
ID:DMCubINVR6TstFoe3iv6t_zns11-QP9oqcAG294OpViyZIDrJJltaANJkh45izNDbb

Scale: 3/4"=1'

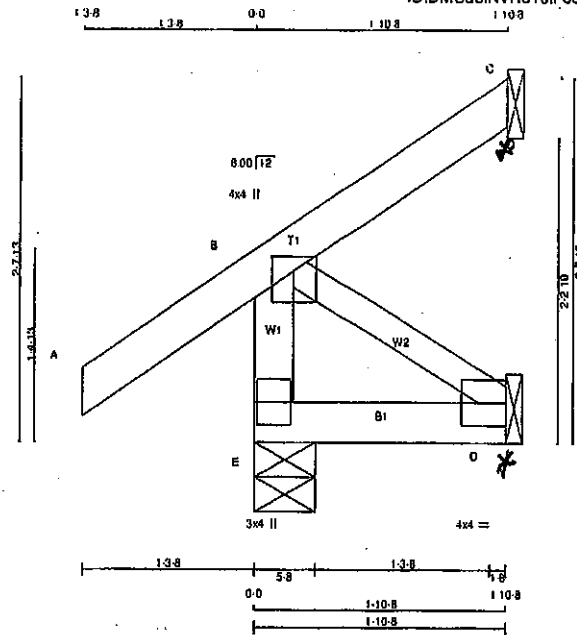

TOTAL WEIGHT = 4 X 9 = 37 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4 DRY	No.2	SPF		
A - C	2x4 DRY	No.2	SPF		
E - D	2x4 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT. TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
D	BMV1-t	MT20	4.0	4.0	2.00	Edge
E	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS, AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	274	0	274	0	0	5-8	5-8
C	40	0	40	0	-36	1-8	1-8
D	18	0	18	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS	MAX/MIN COMPONENT REACTIONS						
	1ST CASE	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
JT	191	144 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0
E	27	22 / -28	0 / 0	0 / 0	0 / 0	5 / 0	0 / 0
C	13	0 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS					WEBS				
MAX. FACTORED		FACTORED			MAX. FACTORED		MAX. FACTORED		
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. LC1 (LC)	MAX. CS1 (LC)	UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM				FR-TO			
E-B	-258 / 0	0.0	0.0	0.03 (1)	7.81				
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	E-D	0 / 0	0.00 (1)	
B-C	-26 / 0	-91.8	-91.8	0.12 (1)	6.25				
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/899 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (B-D:1), SSI=0.09/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)




Structural component only.
DWG# T-2007015

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408131	J4	10	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:07:21 2020 Page 1
ID:DMCubINVR6TsIFo831v6I_zns1l-ubjA1xBupSCI?z4xWT4umWOCViemNddtZLpHdkzNDba

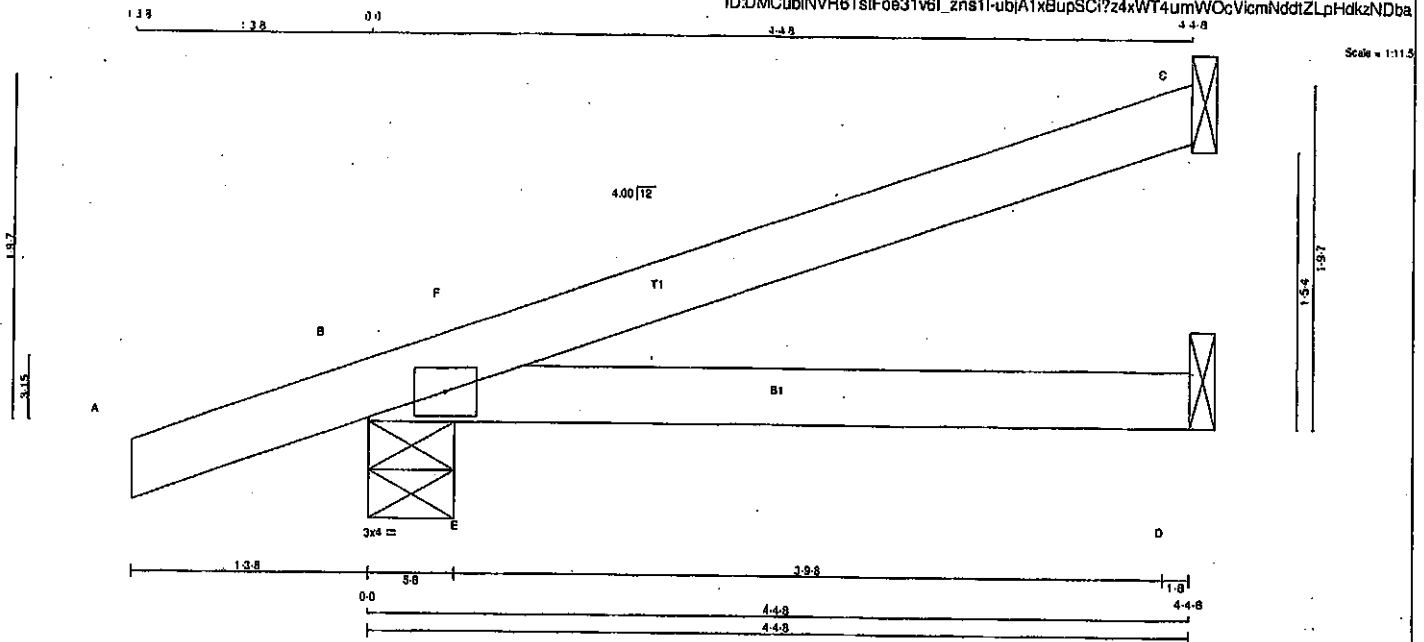

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
B - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B TMB1-1	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT HORZ	DOWN HORZ UPLIFT	IN-SX	IN-SX
C 174 0	174 0 0	1-8	1-8
B 384 0	384 0 0	5-8	5-8
D 68 0	68 0 0	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
JT	1ST CASE COMBINED	MAX. MIN. COMPONENT REACTIONS SNOW	LIVE	PERM. LIVE	WIND	DEAD	SC
C	120	93/0	0/0	0/0	0/0	27/0	0/0
B	255	180/0	0/0	0/0	0/0	75/0	0/0
D	50	19/0	0/0	0/0	0/0	32/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. (PLF)	LOAD LC1	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM	TO			FR-TO			
A-B	0/18	-91.8	-91.8	0.11 (1)	10.00	E-F	-194/7	0.00 (1)	
B-F	-14/0	-91.8	-91.8	0.05 (4)	6.25				
F-C	0/2	-91.8	-91.8	0.22 (1)	10.00				
B-E	0/0	-18.5	-18.5	0.17 (1)	10.00				
E-D	0/0	-18.5	-18.5	0.17 (1)	10.00				

TOTAL WEIGHT = 10 X 12 = 119 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.02")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.05")

CS1: TC=0.22/1.00 (C-F:1), 8C=0.17/1.00 (D-E:1),
WB=0.00/1.00 (E-F:1), SS1=0.16/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (B) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007016


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408133	J30	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

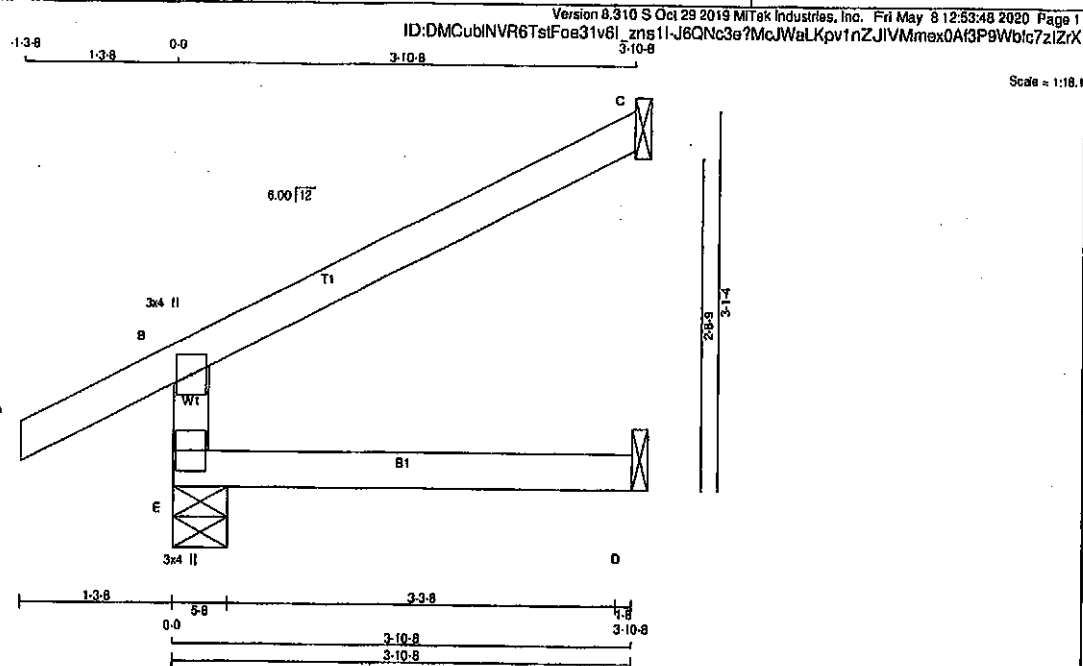

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:35:47 2020 Page 1
ID:DMCubINVR6TstF0e31v6l_zns1l-xoo64Hq72d8eg8VqSihyvG2AMPux5B9_sm4ZVszNDAw

Scale = 1/2" = 1'-0"

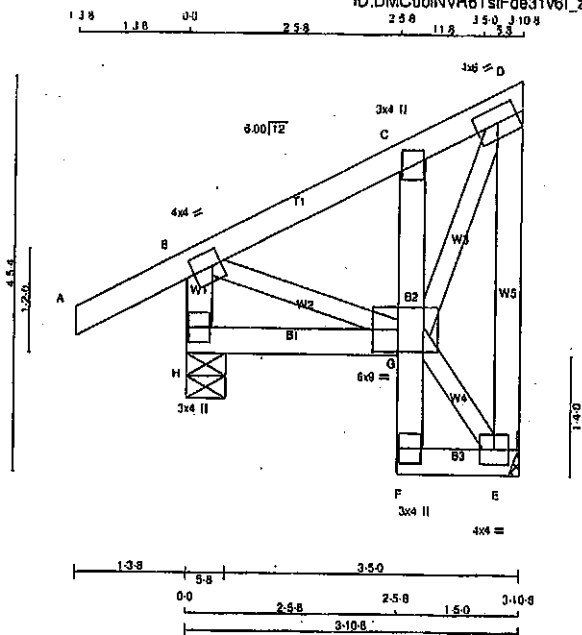

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
H - B	2x4	DRY	No.2
A - D	2x4	DRY	No.2
H - G	2x4	DRY	No.2
F - C	2x4	DRY	No.2
F - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	4.0	2.00	1.25
C	TMV+p	MT20	3.0	4.0		
D	TMVW-1	MT20	4.0	6.0	2.00	3.00
E	BMVW-1	MT20	4.0	4.0		
F	BMV+p	MT20	3.0	4.0		
G	BVMW-1	MT20	6.0	9.0	3.00	3.50
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
H	330	0	330	0	0	5-8	5-8
E	206	0	206	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
	231	165 / 0	0 / 0	0 / 0	0 / 0	66 / 0	0 / 0
H	145	95 / 0	0 / 0	0 / 0	0 / 0	50 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
H-B	-306 / 0	0.0	0.0 0.03 (1)	B-G	0 / 105	0.02 (1)	
A-B	0 / 28	-91.8	-91.8 0.13 (5)	E-D	-185 / 0	0.04 (1)	
B-C	-104 / 0	-91.8	-91.8 0.07 (1)	G-E	-14 / 0	0.00 (1)	
C-D	-114 / 0	-91.8	-91.8 0.06 (1)	G-D	0 / 229	0.05 (1)	
H-G	0 / 0	-18.5	-18.5 0.04 (4)				
F-G	0 / 12	0.0	0.0 0.02 (1)				
G-C	-221 / 0	0.0	0.0 0.02 (1)				
F-E	0 / 9	-18.5	-18.5 0.01 (4)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 25 = 75 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.13/1.00 (A-B-5), BC=0.04/1.00 (G-H-4), WB=0.05/1.00 (D-G-1), SSI=0.10/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.19 (D) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)

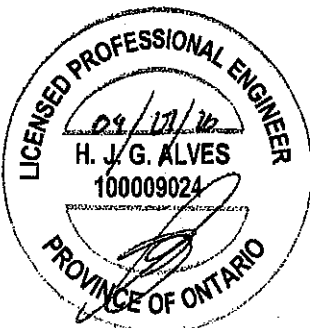

Structural component only
DWG# T-2007040

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408131	C1	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

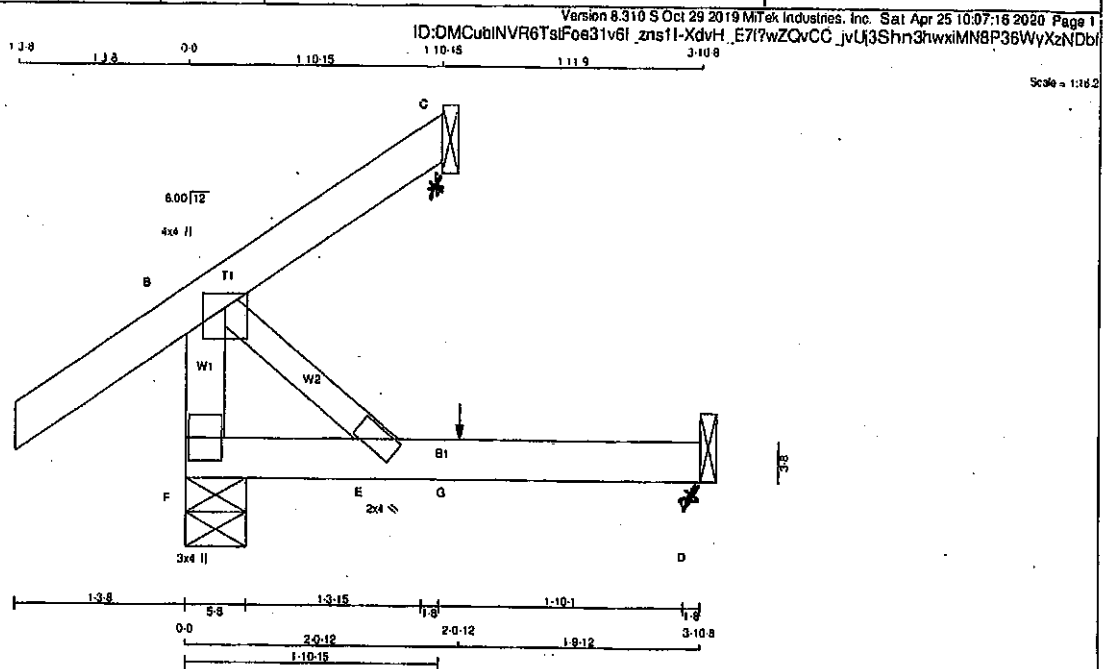

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW+p	MT20	4.0	4.0 1.25 2.00
E	BMVW+p	MT20	2.0	4.0
F	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
F	295	0	295	0	5-8	5-8
C	42	0	42	0	1-8	1-8
D	38	0	40	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT G FOR 160 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED		MAX / MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM. LIVE	WIND			
F	207	144 / 0	0 / 0	0 / 0	83 / 0	0 / 0	0 / 0
C	29	24 / -25	0 / 0	0 / 0	6 / 0	0 / 0	0 / 0
D	28	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		FACTORED		WEBS		FACTORED	
	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)
FR-TO								
F-B	-259 / 0	0.0	0.0	0.03 (1)	7.81	0 / 0	0.00 (1)	
A-B	0 / 35	-91.8	-91.8	0.14 (5)	10.00			
B-C	-25 / 0	-91.8	-91.8	0.13 (5)	6.25			
F-E	0 / 0	-18.5	-18.5	0.08 (4)	10.00			
E-G	0 / 0	-18.5	-18.5	0.08 (4)	10.00			
G-D	0 / 0	-18.5	-18.5	0.08 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	2-0-12	1	1	---	BACK	VERT	TOTAL	---	01

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 11 = 33 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.01")

CSI: TC=0.14/1.00 (A-B:5), BC=0.08/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MAX	MIN	MAX	MIN
MT20	818	354	1887 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.18 (B) (INPUT = 0.90)
JSI METAL=0.05 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007012

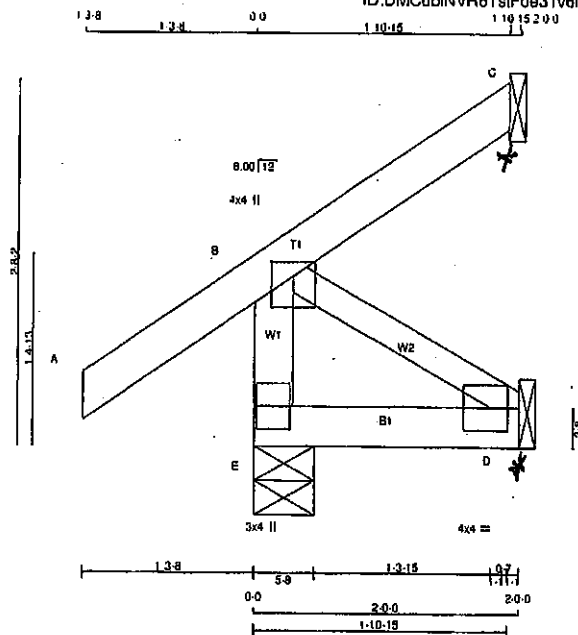

TOTAL WEIGHT = 3 X 10 = 29 lb

DESCR.
SPF
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT 8RG	REQD 8RG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
E	276	0	276	0	0	5-8
C	42	0	42	0	-35	1-8
D	18	0	20	0	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LOOSE COMBINED	MAX./MIN. COMPONENT REACTIONS					SOIL
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	
E	192	144 / 0	0 / 0	0 / 0	0 / 0	48 / 0	0 / 0
C	29	24 / -25	0 / 0	0 / 0	0 / 0	6 / 0	0 / 0
D	14	0 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E. C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS					WEBB				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LOAD L1 (MAX)	CS1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)	
FR-TO		FROM TO				FR-TO			
E-B	-259 / 0	0.0	0.0	0.03 (1)	7.81	B-D	0 / 0	0.00 (1)	
A-B	0 / 36	-91.8	-91.8	0.12 (1)	10.00				
B-C	-25 / 0	-91.8	-91.8	0.12 (1)	6.25				
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2016

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL (TL) = $L/360$ (0.19")

CALCULATED VERT. DEFL.(TL) = $L/999$ (0.007)

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (B-D:1), SSI=0.09/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	{PSI}		{PLI}		{PLI}	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007013

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408133	C34	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:35:43 2020 Page 1

ID:DMCubINVR6TslFoe31v6l_zns1f-31ZbFwnV_PeDCXC3Dwc0IQiUKoXf9OzOx86LN5zNDB

Scale = 1:12.4

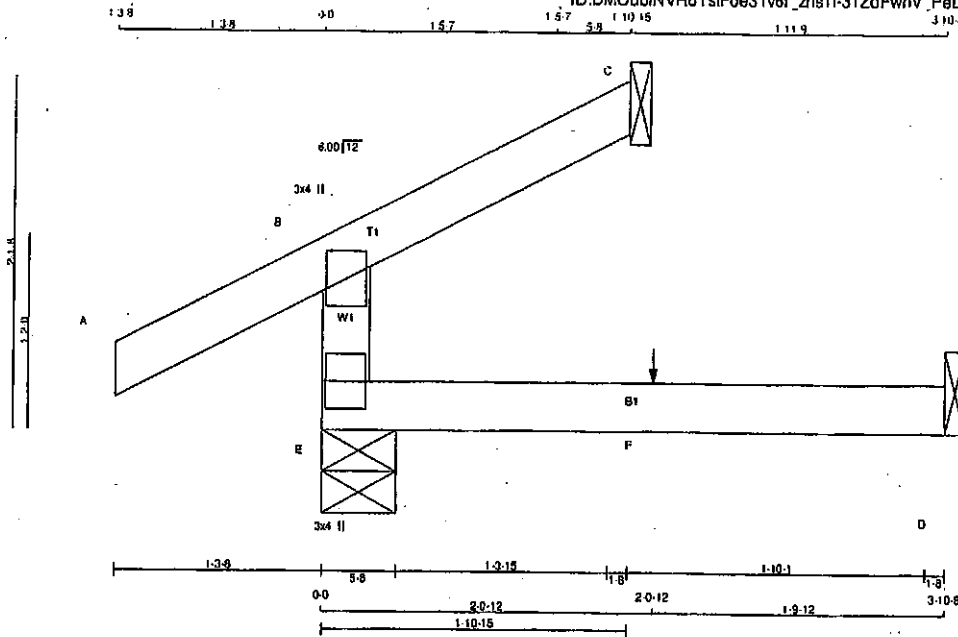

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)			
JT	TYPE	PLATES	W LEN Y X
B	TMV+p	MT20	3.0 4.0
E	BMV1+p	MT20	3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	BRG	IN-SX	BRG	IN-SX
E	275	0	275	0	0	5-8	5-8	5-8	5-8
C	88	0	88	0	0	1-8	1-8	1-8	1-8
D	30	0	34	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST CASE		MAX / MIN		COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	194	130 / 0	0 / 0	0 / 0	0 / 0	64 / 0	0 / 0
C	46	37 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
D	24	0 / 0	0 / 0	0 / 0	0 / 0	24 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE	VERT. LOAD	MAX	MEMB.	FORCE
(LBS)	(PLF)	CS1 (LC)	UNBRAC	(LBS)	CS1 (LC)
FR-TO	FROM	TO	LENGTH	FR-TO	
E-B	-234 / 0	0.0	0.0 0.05 (4)	7.81	
A-B	0 / 28	-91.8	-91.8 0.14 (5)	10.00	
B-C	-10 / 0	-91.8	-91.8 0.06 (1)	10.00	
E-F	0 / 0	-18.5	-18.5 0.08 (4)	10.00	
F-D	0 / 0	-18.5	-18.5 0.06 (4)	10.00	

FACTORED CONCENTRATED LOADS (LBS)		FACE		DIR.		TYPE		HEEL		CONN.	
JT	LOC	LC1	MAX	MAX+	BACK	VERT	TOTAL	---	---	C1	---
F	2-0-12	1	1	---	---	---	---	---	---	---	---

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 9 = 19 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/899 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/899 (0.01")

CS1: TC=0.14/1.00 (A-B-5), BC=0.06/1.00 (D-E-4),
WB=0.00/1.00 (n/a-0), SS=0.10/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.10 (E) (INPUT = 0.90)
JSI METAL=0.06 (B) (INPUT = 1.00)

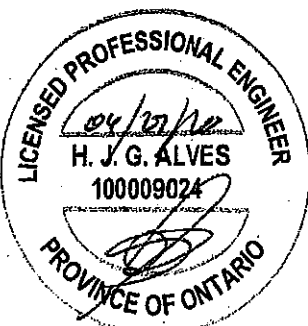


Structural component only
DWG# T-2007037

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO
408133	C35	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

ID:DMCubINVR6TstFoe31v6l_zns11-XD6_SGo7lm4pgmFnd7FHeChpCtburDX8orvuXzNDAz

Version 8.310 S Oct 28 2019 Mitek Industries, Inc. Sat Apr 25 10:35:44 2020 Page 1

Scale = 1:13.4

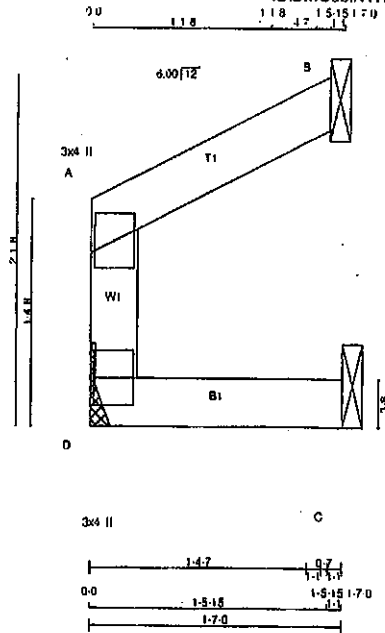

LUMBER			
N.L.G.A. RULES	SIZE	DRY	DESCR.
CHORDS	2x4	DRY	No.2
D - A	2x4	DRY	No.2
A - B	2x4	DRY	No.2
D - C	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMV+p	MT20	3.0	4.0
D	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	JT	GROSS REACTION	BRG	BRG	BRG	BRG
D	83	83	0	0	MECHANICAL	0	0
B	85	85	0	0	1-8	1-8	1-8
C	18	18	0	0	1-8	1-8	1-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	59	38 / 0	0 / 0	0 / 0	0 / 0	21 / 0	0 / 0	0 / 0
B	45	38 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0	0 / 0
C	14	2 / 0	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE	VERT. LOAD	LC1 MAX	MEMB.	FORCE	MAX	CS1 (LC)
FR-TO	(LBS)	(PLF)	CS1 (LC)	UNBRAC	LENGTH	FR-TO	
D-A	-72 / 0	0.0	0.0	0.01 (1)	7.81		
A-B	-2 / 0	-91.8	-91.8	0.03 (1)	10.00		
D-C	0 / 0	-18.5	-18.5	0.01 (4)	10.00		

TOTAL WEIGHT = 5 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD.

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CB1: TC=0.03/1.00 (A-B:1), BC=0.01/1.00 (C-D:4),
WB=0.00/1.00 (n/a:0), SS1=0.05/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.03 (D) (INPUT = 0.90)
JSI METAL= 0.02 (A) (INPUT = 1.00)



Structural component only
DWG# T-2007038


JOB NAME 408268	TRUSS NAME T32	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mtak Industries, Inc. Tue Apr 28 09:54:33 2020 Page 1

ID:DMCubINVR6TstFos31v8l_zns1l-5qB7FpkCjvDMQeWnoW9RsdwD7WQB2ovGsM8dzMEVa

35-2.0 38-5.8 1-3.8

Scale = 1:127.6

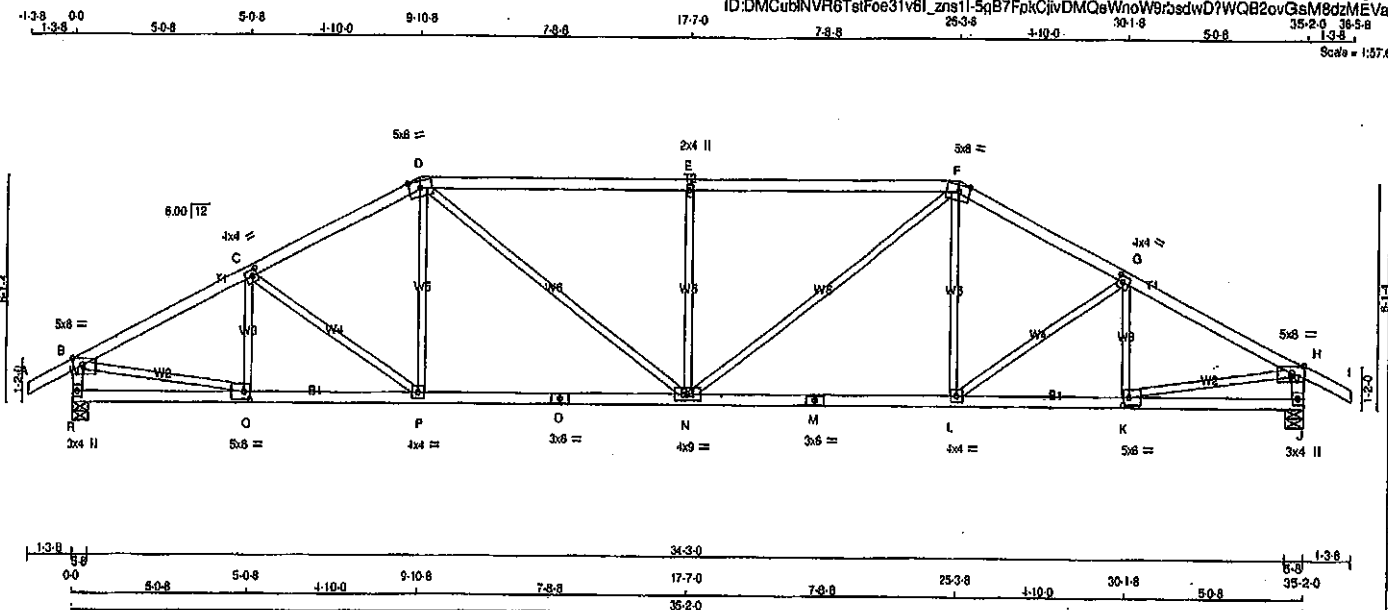

TOTAL WEIGHT = 2 X 139 = 277 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - B	2x4	DRY	No.2
B - H	2x4	DRY	No.2
H - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
		GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
R	2063	0	2063	0	0	5-8	5-8		
J	2063	0	2063	0	0	5-8	5-8		
UNFACTORED REACTIONS									
1ST CASE MAX./MIN. COMPONENT REACTIONS									
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
R	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0		
J	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0		

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF
SPACING	= 24.0 IN. OC
LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12	

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	8.0	Edge 3.50
C	TMVW-t	MT20	4.0	4.0	2.00 1.75
D	TTWW-m	MT20	5.0	8.0	2.25 3.75
E	TMVW-w	MT20	2.0	4.0	
F	TTWW-m	MT20	5.0	8.0	2.25 3.75
G	TMVW-t	MT20	4.0	4.0	2.00 1.75
H	TMVW-p	MT20	5.0	8.0	Edge 3.50
J	BMV1-p	MT20	3.0	4.0	
K	BMVW-t	MT20	5.0	8.0	2.50 2.00
L	BMVW-t	MT20	4.0	4.0	
M	BS-t	MT20	3.0	6.0	
N	BMVW-w	MT20	4.0	9.0	
O	BS-t	MT20	3.0	6.0	
P	BMVW-t	MT20	4.0	4.0	
Q	BMVW-t	MT20	5.0	8.0	2.50 2.00
R	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J									
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.78 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.									
LOADING									
TOTAL LOAD CASES: (4)									
CHORDS									
MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1 MAX	MAX.	MEMB.	MAX. FACTORED	FACTORED	MAX.
	FORCE	(PLF)	(LBS)	CS1 (LC)	UNBRAC		FORCE	(LBS)	CS1 (LC)
FR-TO		FROM	TO	LENGTH	FR-TO				
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	Q-C	-353 / 0	0.08 (1)	
B-C	-2834 / 0	-91.8	-91.8	0.39 (1)	3.61	C-P	-210 / 0	0.13 (1)	
C-D	-2887 / 0	-91.8	-91.8	0.37 (1)	3.91	P-D	0 / 246	0.06 (4)	
D-E	-3080 / 0	-91.8	-91.8	0.97 (1)	2.78	D-N	0 / 844	0.19 (1)	
E-F	-3080 / 0	-91.8	-91.8	0.97 (1)	2.78	N-E	-872 / 0	0.51 (1)	
F-G	-2887 / 0	-91.8	-91.8	0.37 (1)	3.91	N-F	0 / 844	0.19 (1)	
G-H	-2834 / 0	-91.8	-91.8	0.39 (1)	3.61	L-F	0 / 246	0.06 (4)	
H-I	0 / 28	-91.8	-91.8	0.12 (1)	10.00	L-G	-210 / 0	0.13 (1)	
R-B	-2018 / 0	0.0	0.0	0.20 (1)	5.94	K-G	-353 / 0	0.08 (1)	
J-H	-2018 / 0	0.0	0.0	0.20 (1)	5.94	B-Q	0 / 2591	0.58 (1)	
						K-H	0 / 2591	0.58 (1)	
R-Q	0 / 0	-18.5	-18.5	0.10 (4)	10.00				
Q-P	0 / 2555	-18.5	-18.5	0.51 (1)	10.00				
P-O	0 / 2386	-18.5	-18.5	0.49 (1)	10.00				
O-N	0 / 2386	-18.5	-18.5	0.49 (1)	10.00				
N-M	0 / 2386	-18.5	-18.5	0.49 (1)	10.00				
M-L	0 / 2386	-18.5	-18.5	0.49 (1)	10.00				
L-K	0 / 2555	-18.5	-18.5	0.51 (1)	10.00				
K-J	0 / 0	-18.5	-18.5	0.10 (4)	10.00				

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.17")

CALCULATED VERT. DEFL.(LL) = $L/999$ (0.17")

ALLOWABLE DEFL.(TL) = $L/360$ (1.17")

CALCULATED VERT. DEFL.(TL) = $L/999$ (0.34")

CS1: TC=0.97/1.00 (D-E:1), BC=0.51/1.00 (K-L:1), WB=0.58/1.00 (H-K:1), SS=0.34/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.87 (D) (INPUT = 0.90)

JSI METAL=0.82 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007716

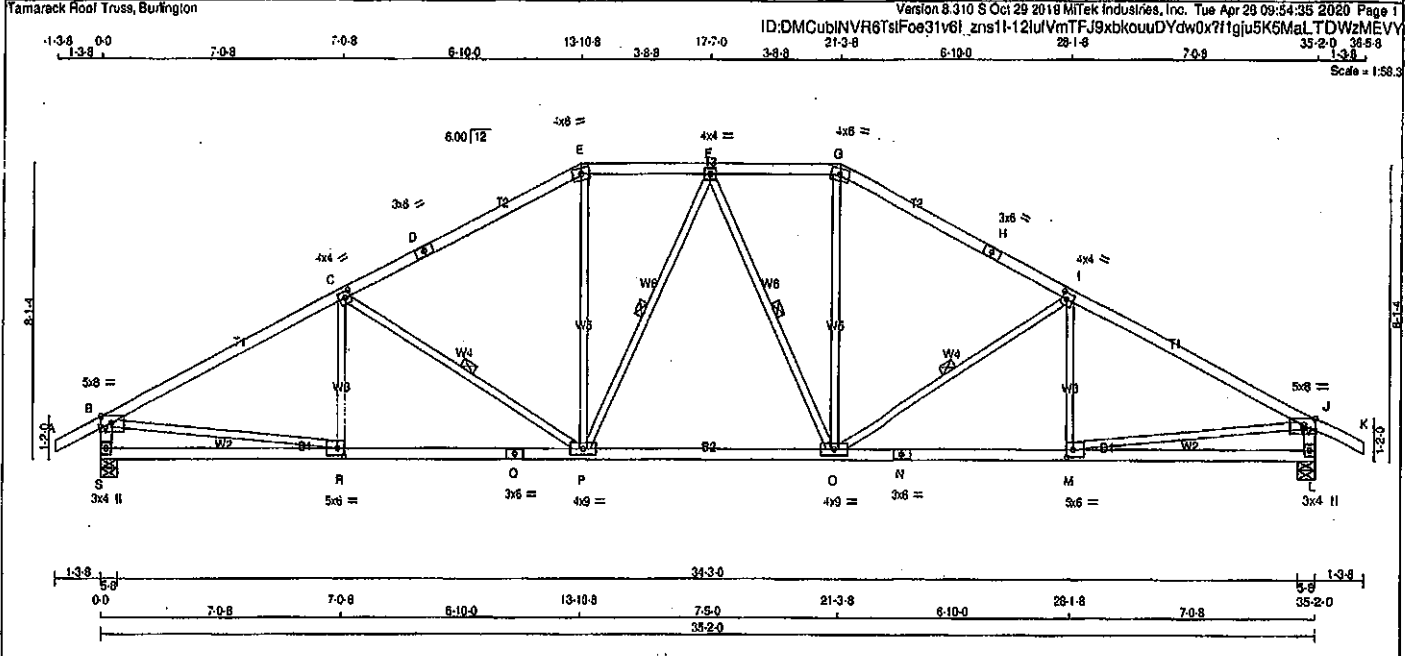

TOTAL WEIGHT = 2 X 145 = 291 lb (M/F)

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - H	2x4	DRY	No.2	SPF
H - K	2x4	DRY	No.2	SPF
S - B	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
S - O	2x4	DRY	No.2	SPF
Q - N	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	8.0	Edge	3.50
C	TMWV-p	MT20	4.0	4.0	Edge	2.00
D	TS-1	MT20	3.0	6.0		
E	TTW-m	MT20	4.0	4.0		
F	TMWV-l	MT20	4.0	4.0		
G	TTW-m	MT20	4.0	4.0		
H	TS-1	MT20	3.0	6.0		
I	TMWV-l	MT20	4.0	4.0	2.00	1.75
J	TMWV-p	MT20	5.0	8.0	Edge	3.50
L	BMV1-p	MT20	3.0	4.0		
M	BMWV-l	MT20	5.0	6.0	2.50	2.25
N	BS-1	MT20	3.0	6.0		
O	BMWV-l	MT20	4.0	9.0		
P	BMWV-l	MT20	4.0	9.0		
Q	BS-1	MT20	3.0	6.0		
R	BMWV-l	MT20	5.0	6.0	2.50	2.25
S	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
S	2083	2083	0	5-8
L	2083	2083	0	5-8

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	MAX. MIN. COMPONENT REACTIONS	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	1457	969/0	0/0	0/0	0/0	488	0	0/0
L	1457	969/0	0/0	0/0	0/0	488	0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-P, F-P, F-O, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (L)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (L)	CS (L)
FR-TO				FR-TO			
A-B	0/28	-91.8	-91.8 0.12 (1)	10.00	R-C	-182.52	0.06 (1)
B-C	-2906/0	-91.8	-91.8 0.83 (1)	3.25	O-P	-637/0	0.29 (1)
C-D	-2373/0	-91.8	-91.8 0.72 (1)	3.66	P-E	0/974	0.15 (1)
D-E	-2373/0	-91.8	-91.8 0.72 (1)	3.66	F-F	-222/0	0.11 (1)
E-F	-2100/0	-91.8	-91.8 0.19 (1)	4.53	F-O	-222/0	0.11 (1)
F-G	-2100/0	-91.8	-91.8 0.19 (1)	4.53	O-G	0/874	0.15 (1)
G-H	-2373/0	-91.8	-91.8 0.72 (1)	3.66	O-I	-837/0	0.29 (1)
H-I	-2373/0	-91.8	-91.8 0.72 (1)	3.66	M-I	-182/52	0.06 (1)
I-J	-2906/0	-91.8	-91.8 0.83 (1)	3.25	B-R	0/2649	0.80 (1)
J-K	0/28	-91.8	-91.8 0.12 (1)	10.00	M-J	0/2849	0.80 (1)
S-B	-2008/0	0.0	0.0 0.20 (1)	5.96			
L-J	-2008/0	0.0	0.0 0.20 (1)	5.96			
S-R	0/0	-18.5	-18.5 0.20 (4)	10.00			
R-O	0/2830	-18.5	-18.5 0.52 (1)	10.00			
O-P	0/2830	-18.5	-18.5 0.52 (1)	10.00			
P-O	0/2193	-18.5	-18.5 0.45 (1)	10.00			
D-N	0/2830	-18.5	-18.5 0.52 (1)	10.00			
N-M	0/2830	-18.5	-18.5 0.52 (1)	10.00			
M-L	0/0	-18.5	-18.5 0.20 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(35 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')

CALCULATED VERT. DEFL.(LL) = U/999 (0.14')

ALLOWABLE DEFL.(TL) = L/360 (1.17')

CALCULATED VERT. DEFL.(TL) = U/999 (0.30')

CS: TC=0.83/1.00 (J-I:1), BC=0.52/1.00 (M-O:1), WB=0.60/1.00 (J-M:1), SI=0.28/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1687 799 1987 1956

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (M) (INPUT = 0.80)

JSI METAL = 0.79 (Q) (INPUT = 1.00)



Structural component only
DWG# T-2007718


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408268	T35	2	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:54:36 2020 Page 1

ID:DMCubINVR6TslFoe31v8l_zns1l-VEsGlrn50dHoDuN4Sx4sTDUGAQ0ldYMEbE41lyzMEVX

Scale = 1:50.0

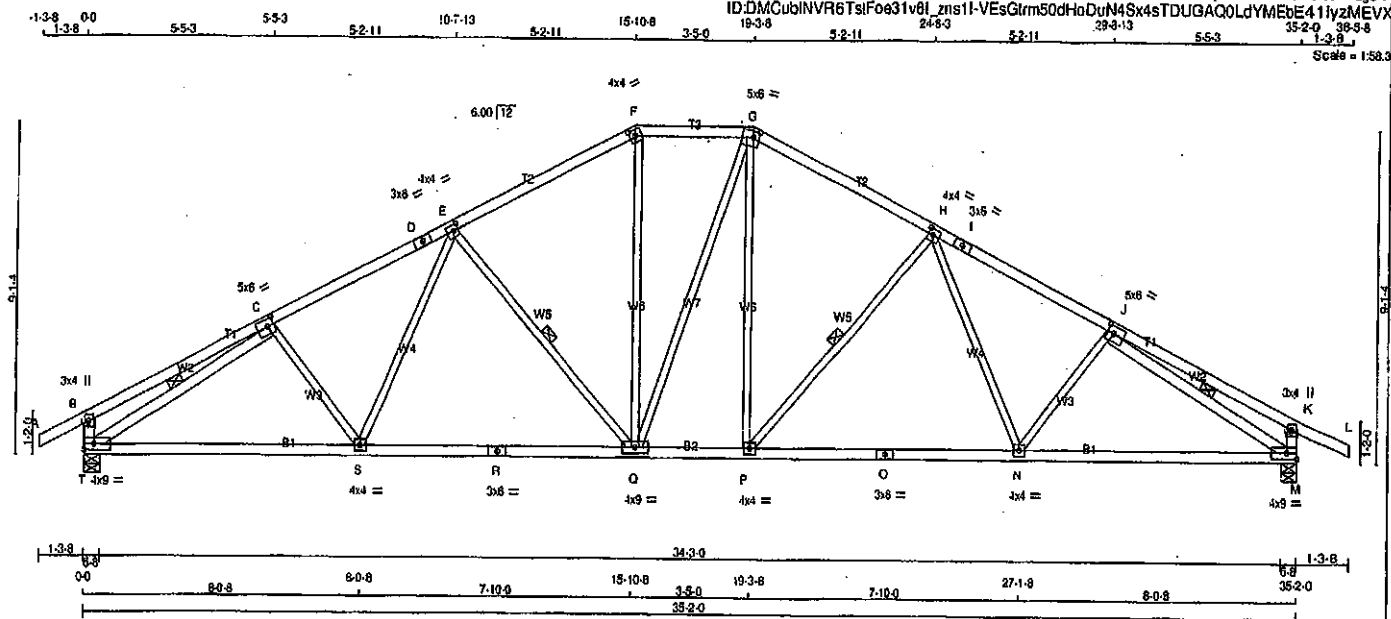

TOTAL WEIGHT = 2 X 155 = 310 lb (M/F)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - G	2x4	DRY	No.2	SPF	
G - I	2x4	DRY	No.2	SPF	
I - L	2x4	DRY	No.2	SPF	
L - R	2x4	DRY	No.2	SPF	
R - K	2x4	DRY	No.2	SPF	
K - O	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
T - C	2x4	DRY	No.2	SPF	
J - M	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMWW-i	MT20	5.0	8.0	2.50	2.25
D TS-i	MT20	3.0	8.0		
E TMWW-i	MT20	4.0	4.0	2.00	1.50
F TTW-h	MT20	4.0	4.0	2.00	1.75
G TTWW-m	MT20	5.0	8.0	2.00	2.00
H TMWW-i	MT20	4.0	4.0	2.00	1.50
I TS-i	MT20	3.0	8.0		
J TMWW-i	MT20	5.0	8.0	2.50	2.25
K TMV+p	MT20	3.0	4.0		
M BMVW-i	MT20	4.0	9.0		Edge
N, P, S					
N BMWW-i	MT20	4.0	4.0		
O BS-i	MT20	3.0	8.0		
Q BMWW-i	MT20	4.0	9.0		
R SS-i	MT20	3.0	8.0		
T BMVW-i	MT20	4.0	9.0		Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
T	2063 0	2063 0	5-8	5-8
M	2063 0	2063 0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
T	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 3	0 / 0	0 / 0
M	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, H-P, C-T, J-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	CS1 (LC)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	CS1 (LC)
FR-TO						FR-TO				
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	C-S	-110 / 37	0.64 (1)		
B-C	0 / 20	-91.8	-91.8	0.32 (1)	10.00	S-E	0 / 277	0.06 (1)		
C-D	-2760 / 0	-91.8	-91.8	0.40 (1)	3.88	E-Q	-681 / 0	0.31 (1)		
D-E	-2760 / 0	-91.8	-91.8	0.40 (1)	3.88	Q-F	0 / 613	0.14 (1)		
E-F	-2187 / 0	-91.8	-91.8	0.38 (1)	4.30	F-G	0 / 4	0.00 (1)		
F-G	-1925 / 0	-91.8	-91.8	0.18 (1)	4.71	P-G	0 / 609	0.14 (1)		
G-H	-2185 / 0	-91.8	-91.8	0.38 (1)	4.30	H-N	-683 / 0	0.31 (1)		
H-I	-2781 / 0	-91.8	-91.8	0.40 (1)	3.88	N-J	0 / 279	0.06 (1)		
I-J	-2781 / 0	-91.8	-91.8	0.40 (1)	3.88	J-M	-110 / 37	0.04 (1)		
J-K	0 / 20	-91.8	-91.8	0.32 (1)	10.00	T-C	-3042 / 0	0.61 (1)		
K-L	0 / 28	-91.8	-91.8	0.12 (1)	10.00	C-M	-3043 / 0	0.61 (1)		
L-M	-325 / 0	0.0	0.0	0.03 (1)	7.81					
M-K	-325 / 0	0.0	0.0	0.03 (1)	7.81					
T-S	0 / 2538	-18.5	-18.5	0.56 (1)	10.00					
S-R	0 / 2382	-18.5	-18.5	0.53 (1)	10.00					
R-Q	0 / 2382	-18.5	-18.5	0.53 (1)	10.00					
Q-P	0 / 1924	-18.5	-18.5	0.40 (1)	10.00					
P-O	0 / 2382	-18.5	-18.5	0.53 (1)	10.00					
O-N	0 / 2382	-18.5	-18.5	0.53 (1)	10.00					
N-M	0 / 2538	-18.5	-18.5	0.56 (1)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/899 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.29")

CS1: TC=0.40/1.00 (H-J:1), BC=0.50/1.00 (M-N:1), WB=0.61/1.00 (J-M:1), SS=0.20/1.00 (B-C:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
	768	1987	1856


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (F) (INPUT = 0.90)
JSI METAL= 0.83 (O) (INPUT = 1.00)



Structural component only
DWG# T-2007719

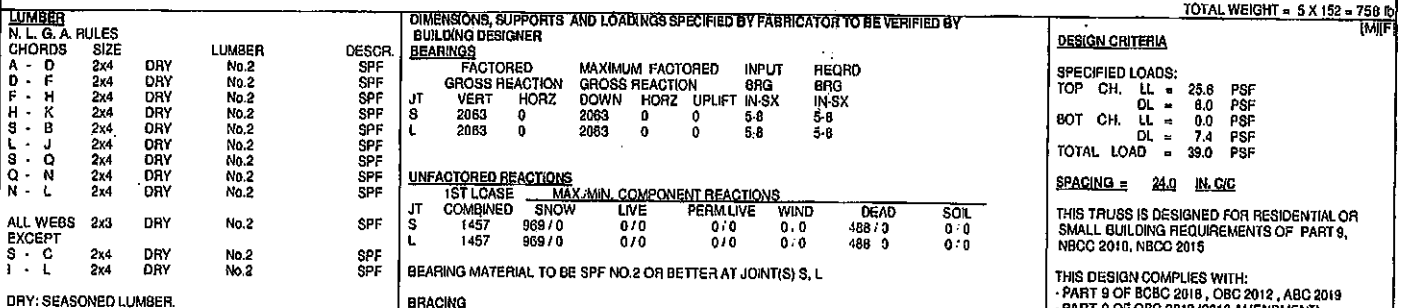

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER								
<u>BEARINGS</u>								
	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG UPLIFT	REQ'D BRG IN-SX	REQ'D BRG IN-SX	
	VERT	HORZ	DOWN	HORZ				
JT	2063	0	2063	0	0	5-8	5-8	
S	2063	0	2063	0	0	5-8	5-8	
L	2063	0	2063	0	0	5-8	5-8	

<u>UNFACTORED REACTIONS</u>							
	1ST LCASE COMBINED	MAX. MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	1457	969 / 0	0 / 0	0 / 0	0 / 0	-88 / 3	0 / 0
S	1457	969 / 0	0 / 0	0 / 0	0 / 0	-88 / 3	0 / 0
L	1457	969 / 0	0 / 0	0 / 0	0 / 0	-88 / 3	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, I-L

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	LC1 MAX CSI (LC)	MAX. UNBRAG LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO		FR-TO			
A-B	0:28	-91.8	-91.8	1.12 (1)	10.00	F-O	0:866
B-C	0:22	-91.8	-91.8	0.40 (1)	10.00	O-G	-726.0
C-D	-2808.0	-91.8	-91.8	0.49 (1)	3.75	G-M	0:391
D-E	-2808.0	-91.8	-91.8	0.49 (1)	3.75	M-I	-192.18
E-F	-2322.0	-91.8	-91.8	0.46 (1)	4.07	P-F	0:866
F-G	-2322.0	-91.8	-91.8	0.46 (1)	4.07	E-P	-726.0
G-H	-2808.0	-91.8	-91.8	0.49 (1)	3.75	R-F	0:391
H-I	-2808.0	-91.8	-91.8	0.49 (1)	3.75	C-R	-192.18
I-J	0:22	-91.8	-91.8	0.40 (1)	10.00	S-C	-3084.0
J-K	0:28	-91.8	-91.8	1.12 (1)	10.00	I-L	-3084.0
S-B	-344.0	0.0	0.0	0.03 (1)	7.81		
L-J	-344.0	0.0	0.0	0.03 (1)	7.81		
S-R	0:2574	-18.5	-18.5	0.53 (1)	10.00		
R-Q	0:2291	-18.5	-18.5	0.47 (1)	10.00		
Q-P	0:2291	-18.5	-18.5	0.47 (1)	10.00		
P-O	0:1782	-18.5	-18.5	0.39 (1)	10.00		
O-N	0:2291	-18.5	-18.5	0.47 (1)	10.00		
N-M	0:2291	-18.5	-18.5	0.47 (1)	10.00		
M-L	0:2574	-18.5	-18.5	0.53 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	=	25.6 PSF
	OL	=	8.0 PSF
BOT CH.	LL	=	0.0 PSF
	OL	=	7.4 PSF
TOTAL LOAD		=	39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL)= L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSI: TC=0.49/1.00 (C-E:1), BC=0.53/1.00 (L-M:1)
WB=0.72/1.00 (E-P:1), SS=0.22/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (C) (INPUT = 0.80)
JSI METAL= 0.77 (D) (INPUT = 1.00)

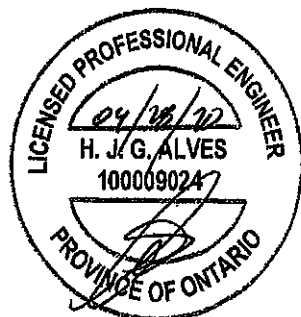

Structural component only
DWG# T-2007720

LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of a) easier installation, b) higher capacities, c) lower installed cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.




Double-Shear Nailing Top View




Double-Shear Nailing Side View; Do not bend tab




Dome Double-Shear Nailing Side View (available on some models)
U.S. Patent 5,603,680

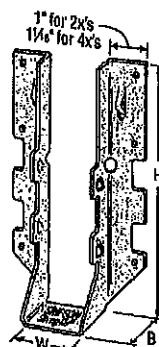


LUS28

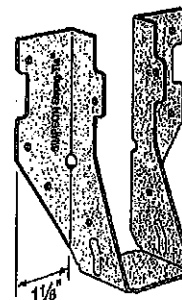


LU26L

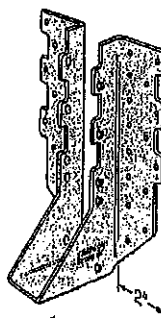

HUS210
(HUS26, HUS28, and HHUS similar)





HGUS28-2



HHUS210-2

Typical HUS26 Installation with Reduced Heel Height
(Truss Designer to provide fastener quantity for connecting multiple members together)

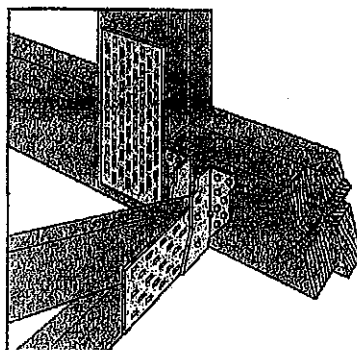

LJS26DS

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options Information on pp. 125–127.


HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value

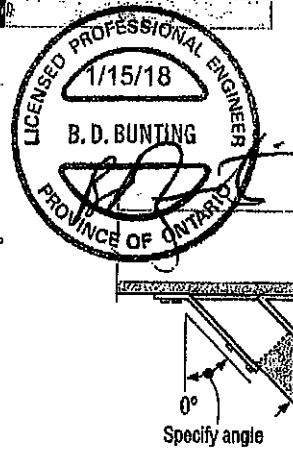

Top View HHUS Hanger Skewed Right
 (Joist must be bevel cut)
 All joist nails installed on the outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ³	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
								lb.	lb.	lb.	lb.
								kN	kN	kN	kN
Single 2x Sizes											
LUS24	18	1 1/8	3 1/4	1 3/4	2 1/4	(4) 10d	(2) 10d	710	1625	645	1155
								3.16	7.23	2.87	5.14
LU24L	22	1 1/8	3	1 1/2	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360	1020	320	725
								1.60	4.54	1.42	3.22
LU26L	22	1 1/8	5	1 1/2	4 1/2	(6) 10d	(4) 10d x 1 1/2"	720	1605	645	1140
								3.20	7.14	2.87	5.07
SS LUS26	18	1 1/8	4 1/4	1 3/4	3 3/4	(4) 10d	(4) 10d	1420	2170	1290	1630
								6.32	9.65	5.74	7.25
HUS28	16	1 1/8	5 3/4	3	3 3/8	(14) 10d	(6) 16d	2705	4940	2065	3875
								11.30	21.97	9.20	17.24
LJS26DS	18	1 1/8	5	3 1/2	4 1/2	(16) 16d	(6) 16d	2055	4265	1460	4115
								9.14	18.97	6.49	18.31
HGUS28	12	1 1/8	5 3/4	5	4 1/2	(20) 16d	(8) 16d	2885	6625	2685	5700
								11.96	29.51	11.96	25.35
LU28L	20	1 1/8	6 3/4	1 1/2	5 1/2	(8) 10d	(6) 10d x 1 1/2"	1140	2185	1020	1550
								5.07	9.72	4.54	6.89
SS LUS28	18	1 1/8	6 3/4	1 3/4	3 3/4	(6) 10d	(4) 10d	1420	2520	1290	1790
								6.32	11.21	5.74	7.96
HUS28	16	1 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3605	5365	2675	4345
								16.04	23.88	11.90	19.33
HGUS28	12	1 1/8	7 1/8	5	6 1/8	(38) 16d	(12) 16d	3310	7675	3310	6900
								14.74	34.19	14.74	30.73
LU210L	20	1 1/8	8	1 1/2	7 1/2	(10) 10d	(6) 10d x 1 1/2"	1140	2495	1020	1770
								5.07	11.10	4.54	7.87
SS LUS210	18	1 1/8	7 1/8	1 3/4	3 3/4	(8) 10d	(4) 10d	1420	2785	1290	2210
								6.32	12.39	5.74	9.83

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSGN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.


Face-Mount Hangers

SIMPSON
Strong-Tie

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _o ^a	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
								lb.	lb.	lb.	lb.
								kN	kN	kN	kN
Double 2x Sizes											
LUS24-2	18	3 3/8	3 3/8	2	1 1/2	(4) 16d	(2) 16d	835	2020	580	1435
SS LUS26-2	18	3 3/8	4 3/8	2	4	(4) 16d	(4) 16d	3.71	8.99	2.62	6.38
								1720	2595	1545	1920
								7.65	11.54	6.87	8.54
HHUS26-2	14	3 3/8	5 3/8	3	3 3/8	(14) 16d	(6) 16d	2850	7335	2065	5205
								12.68	32.63	9.20	23.15
HGUS26-2	12	3 3/8	5 3/8	4	4 3/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
SS LUS28-2	18	3 3/8	7	2	4	(8) 16d	(4) 16d	1720	3325	1545	2575
								7.65	14.79	6.87	11.45
HHUS28-2	14	3 3/8	7 3/8	3	6 3/8	(22) 16d	(8) 16d	3765	8940	2675	6345
								16.75	39.77	11.90	28.22
HGUS28-2	12	3 3/8	7 3/8	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
SS LUS210-2	18	3 3/8	9	2	6	(8) 16d	(6) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HHUS210-2	14	3 3/8	9 3/8	3	8	(30) 16d	(10) 16d	4670	9660	4235	7000
								20.77	42.97	18.84	31.14
HGUS210-2	12	3 3/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/2	4	4 3/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-3	12	4 1/8	7 1/4	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-3	14	4 1/8	9	3	7 3/8	(30) 16d	(10) 16d	4670	9670	4235	6865
								20.77	43.02	18.84	30.54
HGUS210-3	12	4 1/8	9 1/4	4	8 3/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
Quadruple 2x Sizes											
HGUS26-4	12	6 3/8	5 3/8	4	4 3/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-4	12	6 3/8	7 3/8	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-4	14	8 3/8	8 3/8	3	7 3/8	(30) 16d	(10) 16d	4670	10155	4235	7210
								20.77	45.17	18.84	32.07
HGUS210-4	12	6 3/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
HGUS212-4	12	6 3/8	10 3/8	4	10 3/8	(56) 16d	(20) 16d	7840	14995	5425	10645
								33.98	66.70	24.13	47.35
HGUS214-4	12	6 3/8	12 3/8	4	11 3/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80
4x Sizes											
LUS46	18	3 3/8	4 3/8	2	3 3/8	(4) 16d	(4) 16d	1720	2595	1545	1920
								7.65	11.54	6.87	8.54
HHUS46	14	3 3/8	5 3/8	3	3 3/8	(14) 16d	(6) 16d	2540	7335	2065	5205
								11.30	32.83	9.20	23.15
HGUS46	12	3 3/8	5 3/8	4	4 3/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
LUS48	18	3 3/8	6 3/8	2	3 3/8	(6) 16d	(4) 16d	1720	3325	1545	2575
								7.65	14.79	6.87	11.45
HHUS48	14	3 3/8	7 3/8	3	6 3/8	(22) 16d	(8) 16d	3765	8940	2675	6345
								16.75	39.77	11.90	28.22
HGUS48	12	3 3/8	7 3/8	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
LUS410	18	3 3/8	8 3/8	2	5 3/8	(8) 16d	(6) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HGUS410	12	3 3/8	9	4	8 3/8	(46) 16d	(16) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
HGUS412	12	3 3/8	10 3/8	4	10 3/8	(56) 16d	(20) 16d	7840	14995	5425	10645
								33.98	66.70	24.13	47.35
HGUS414	12	3 3/8	12 3/8	4	11 3/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80



Plated Truss Connectors

See footnotes
on p. 258.

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1¼". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1½" = 0.148" dia. x 1½" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

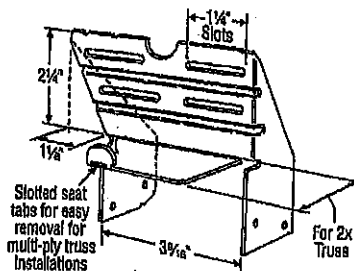


TC24
U.S. Patent 4,932,173

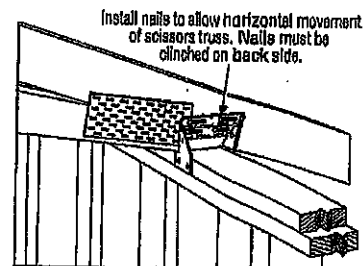


Typical TC24 Installation

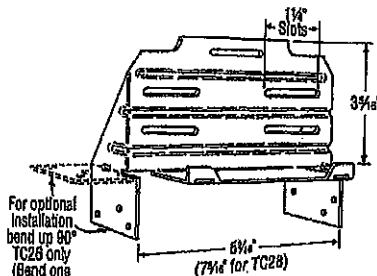

TC26
(TC28 Similar)

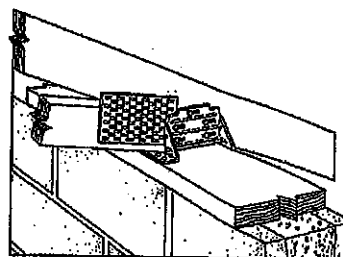

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer
(8", 10", 12" Wall Installation Similar)

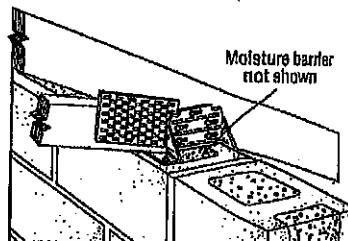

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift ($K_c=1.18$)	Uplift ($K_c=1.18$)
TC24	(4) 10d	(4) 10d	605	430
TC26	(6) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift ($K_c=1.18$)	Uplift ($K_c=1.18$)
TC26	(5) 10d	(6) 10d x 1½"	810	680
	(5) 10d	(6) 10d	930	680

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.
4. TC26 fastened to grouted concrete block with (6) - ¾" x 2¼" Titen screws has a factored uplift resistance of 275 lb.



UNITED STATES DESIGN

© 2017 Simpson Strong-Tie Company Inc.

10/2017 247-0000-01

(800) 999-5099
strongtie.com

H/TSP

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_D = 1.15$)					
					D.Fir-L			S-P-F		
		To Rafters/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(8) 8d x 1½"	(4) 8d	—	740	685	300	680	485	215
					3.29	3.05	1.33	3.02	2.16	0.96
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	765	160	160
					3.58	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	265	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ^a	18	(6) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.99	—	—	4.56	—	—
SS H10A ^a	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	565	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^{a,b}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1465	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.08	2.42	3.47	2.91	1.73
H14	18	① (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
		② (12) 8d x 1½"	(15) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
TSP	18	(9) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
					5.76	1.96	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.96	—	4.92	1.38	—

- Factored resistances have been increased 16% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.6A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 8/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.162" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

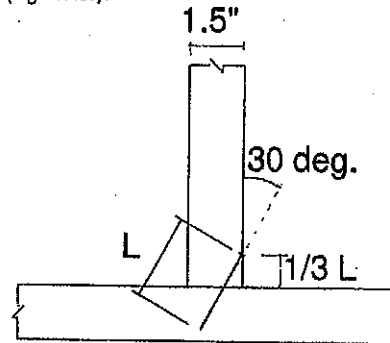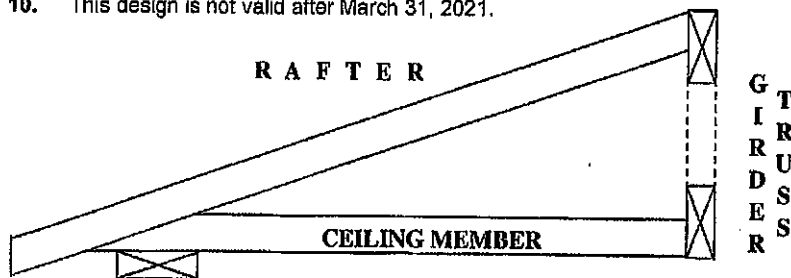


TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to wind or earthquake load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

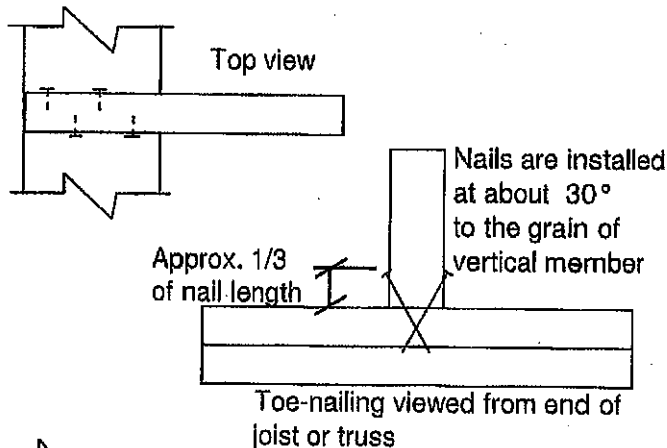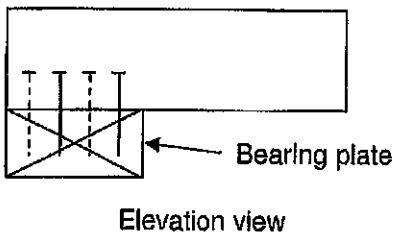

Toe-nailing on 2x4 Bearing Plate

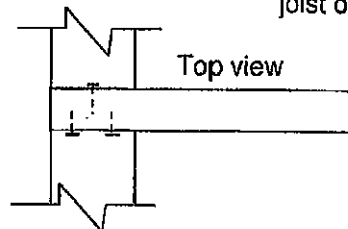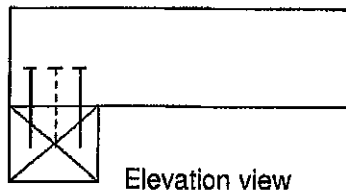

MiTek®

MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7


PEO
Certificate No. 10889486




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint, unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/8" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

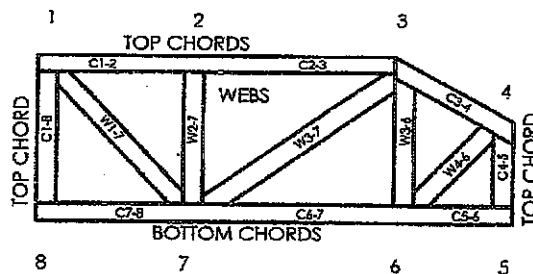

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MII-7473C rev. 10-08



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

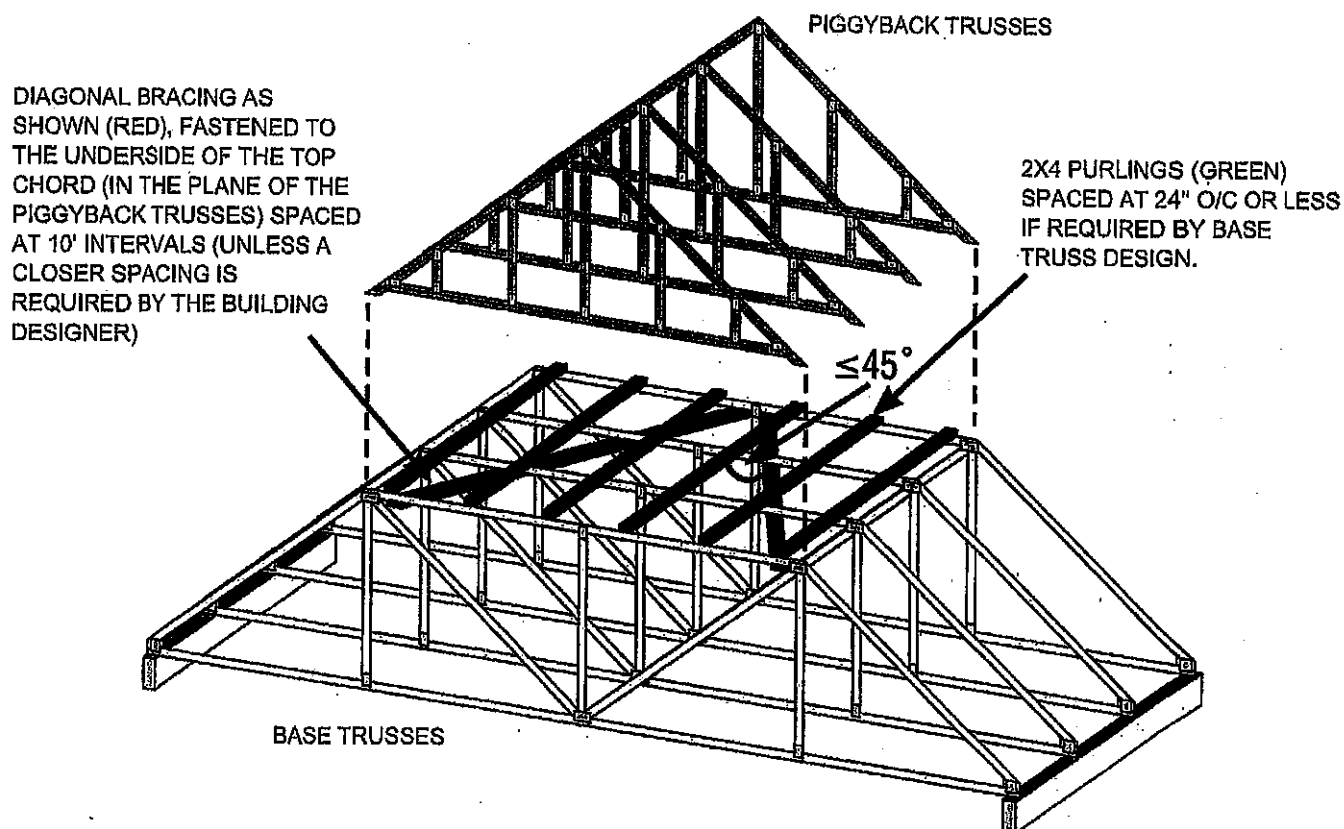

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1300213

Feb 09, 2018