


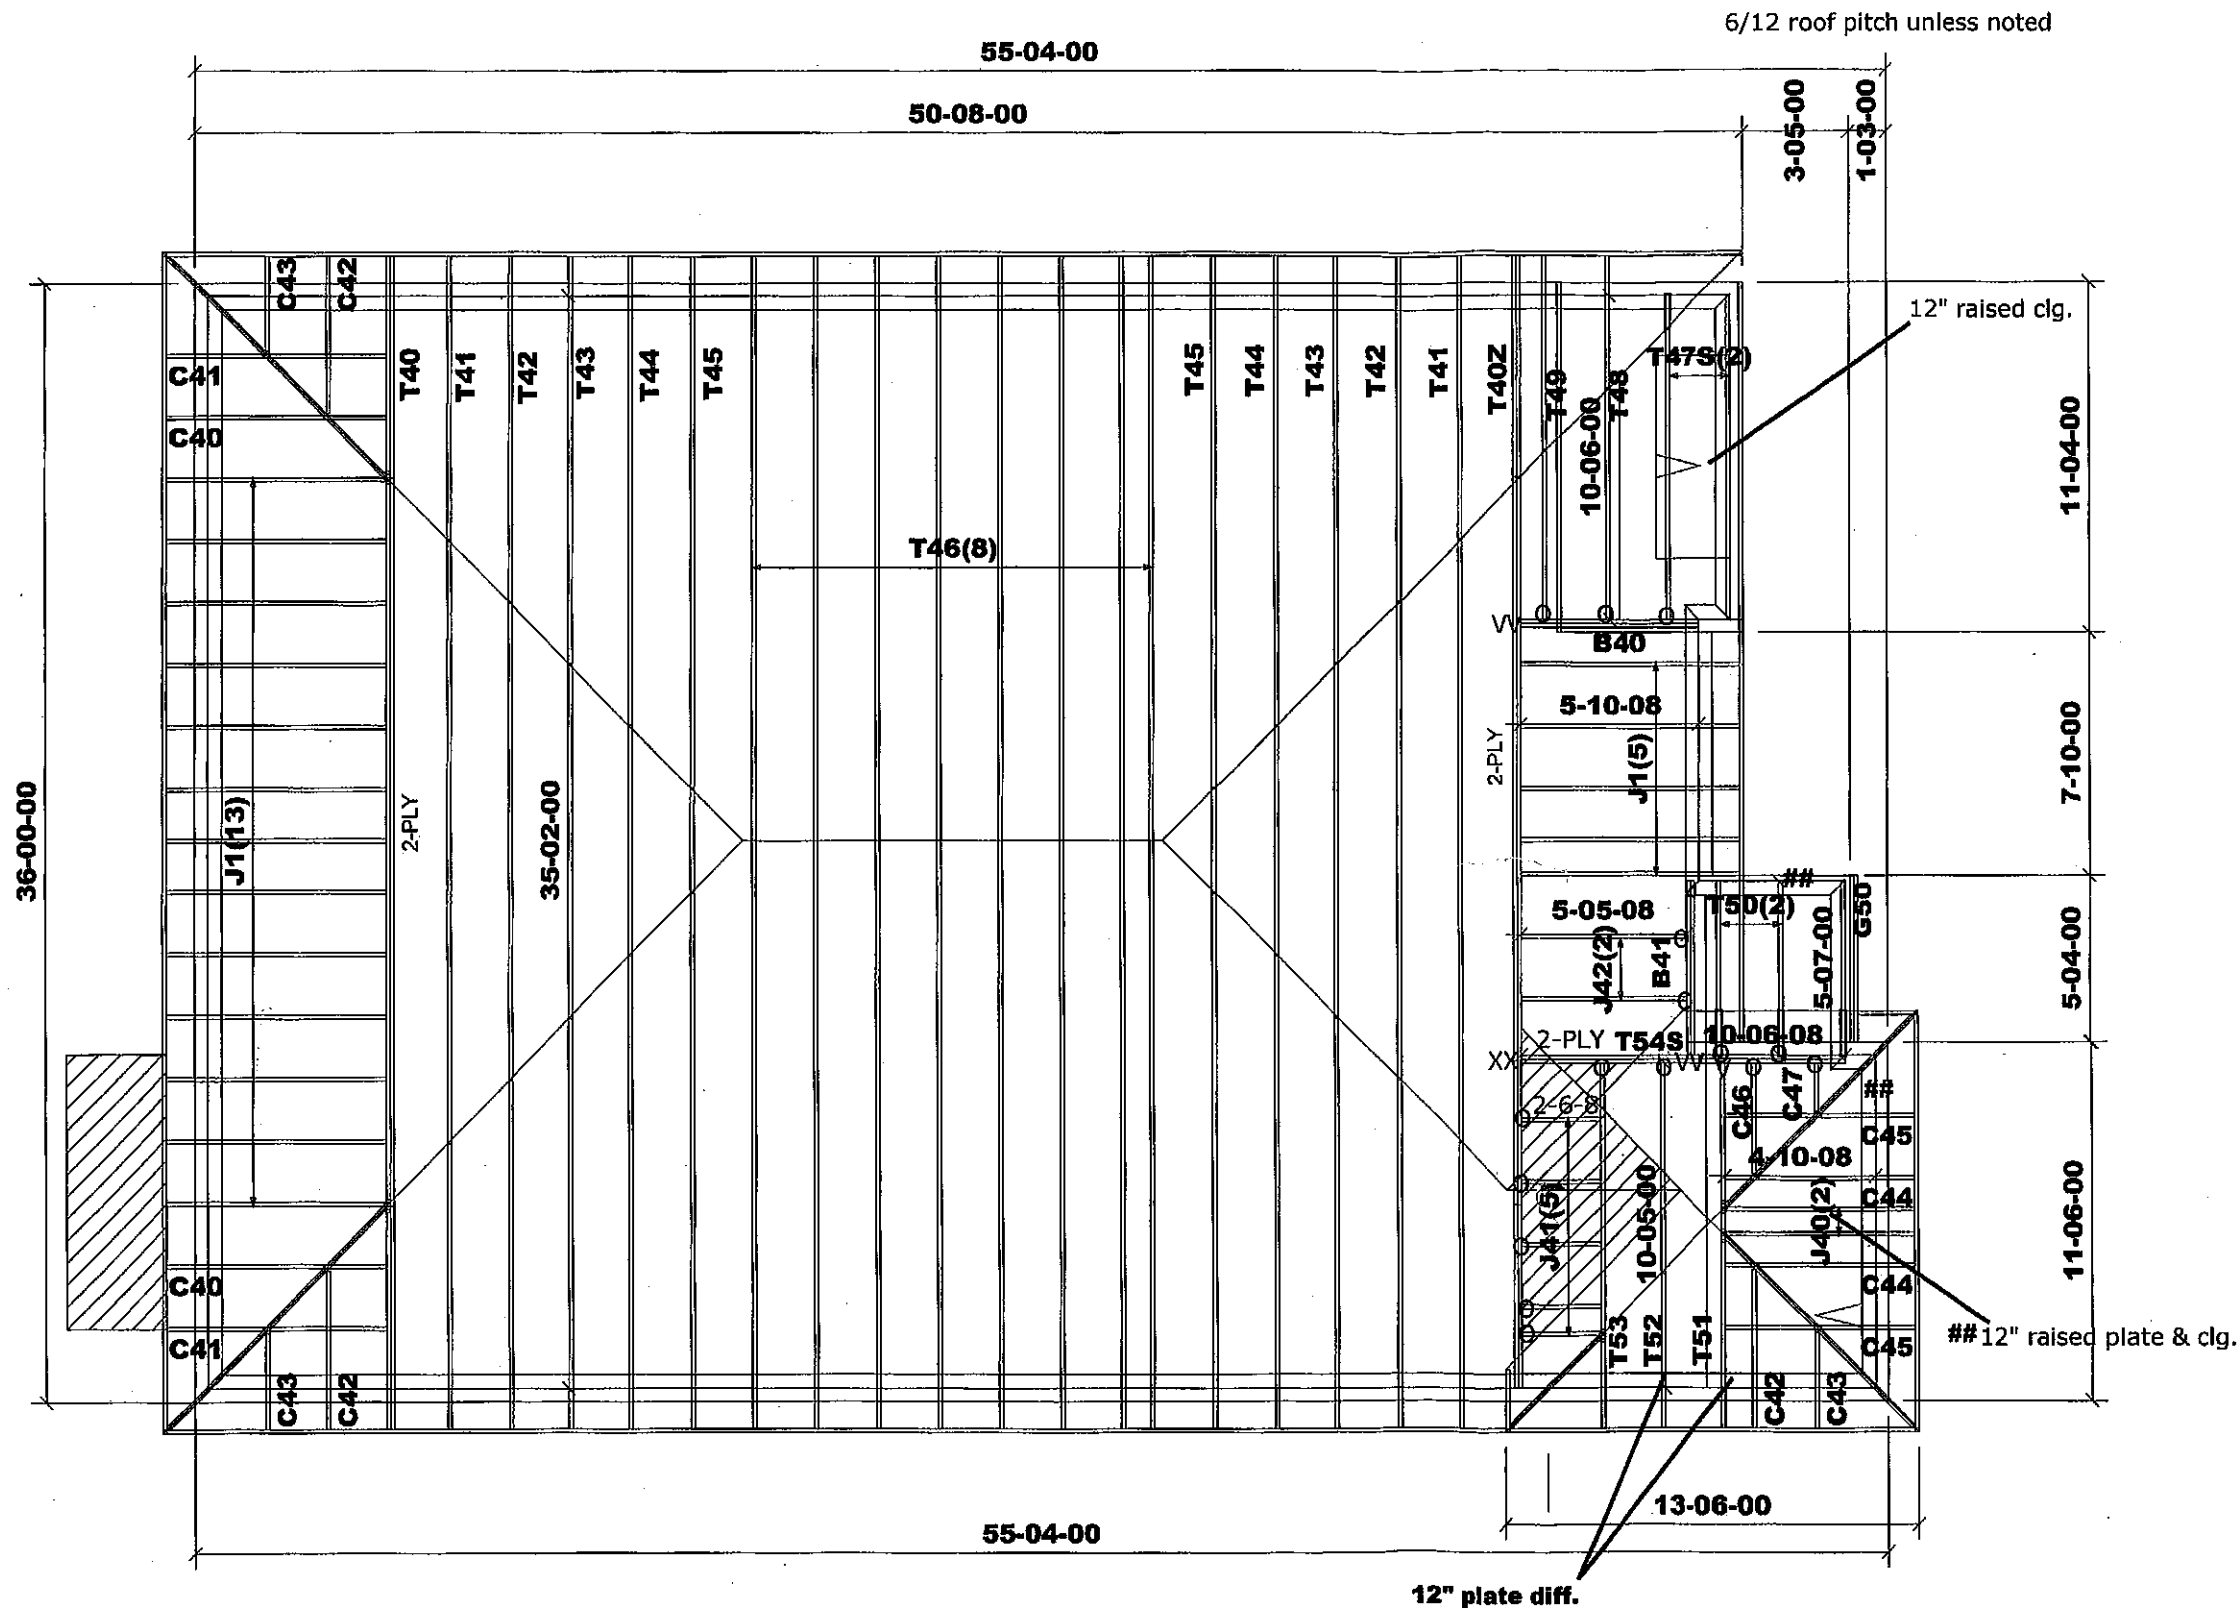

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012
(2019 amendment) OCCUPANCY:
RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
LUS26-2-(VV)

BEAMS:
B40= B41 =
2 - 2x10 SPF #2

CITY OF HAMILTON
Building Division


Permit No. 21-105984

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

FOR CHIEF BUILDING OFFICIAL DATE FEB. 23/21

 DENOTES:
CONVENTIONAL
FRAMING

M13138



Job Track: 51225
Plan Log: 202419
Layout ID: 408224

Builder / Location:
GREEN PARK HOMES / WATERDOWN
Project: RUSSELL GARDENS PH.3
Date: 2020-04-27 Sales: Mario DiCano Designer: JG

Model / Elevation:
MOUNTAINASH 6/3- STD OR OPT.5 BR

Lot 175

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

DELIVERY SHIPLIST




Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 6
 Lot #: 175
 Elevation: 3- STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202419
 Layout ID: 408224
 Ref #
 Page: 1 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T40 Hip Girder	6 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	337.56 208.00		
	1 2-ply	T40Z Hip Girder	6 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	337.56 208.00		
	2	T41 Hip	6 /12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.99 174.00		
	2	T42 Hip	6 /12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.12 174.67		
	2	T43 Hip	6 /12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	289.07 179.67		
	2	T44 Hip	6 /12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	290.73 183.33		
	2	T45 Hip	6 /12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	301.67 191.33		
	8	T46 Common	6 /12	35-02-00	9-11-08	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1178.96 726.33		
	2	T47S Roof Special	0 /12	10-06-00	3-06-00	2 x 4		3-06-00 3-06-00	101.09 63.67		
	1	T48 Half Hip	6 /12	10-06-00	2-08-00	2 x 4	1-03-08	1-02-00 2-08-00	39.94 26.67		
	1	T49 Half Hip	6 /12	10-06-00	3-08-00	2 x 4	1-03-08	1-02-00 3-08-00	41.91 27.50		
	2	T50 Flat	0 /12	5-07-00	3-00-00	2 x 4		3-00-00 3-00-00	45.54 30.00		
	1	G50 GABLE	0 /12	5-07-00	3-00-00	2 x 4		3-00-00 3-00-00	22.18 15.00		
	1	T51 Hip Girder	6 /12	10-05-00	3-07-04	2 x 4	1-03-08	1-02-00 1-03-08	43.52 28.67		

DELIVERY SHIPLIST

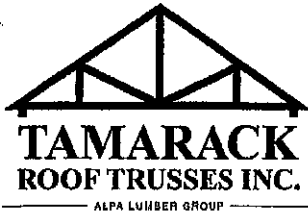

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 6
 Lot #: 175
 Elevation: 3- STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202419
 Layout ID: 408224
 Ref #
 Page: 2 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T52 Hip	6 / 12	10-05-00	4-00-00	2 x 4	1-03-08	2-02-00 2-03-08	45.94 29.83		
	1	T53 Hip Girder	6 / 12	10-05-00	3-00-00	2 x 4	1-03-08	2-02-00 2-03-08	46.32 31.83		
	1 2-ply	T54S Roof Special Girder	0 / 12	10-06-08	2-02-00	2 x 4 2 x 6		1-02-00 2-02-00	97.7 64.33		
	18	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	302.3 192.00		
	2	J40 Jack-Open	6 / 12	4-10-08	3-07-04	2 x 4	1-03-08	1-02-00 3-07-04	28.76 18.67		
	5	J41 Jack-Open	6 / 12	2-06-08	3-00-00	2 x 4		1-08-12 3-00-00	49.19 34.17		
	2	J42 Jack-Open	6 / 12	5-05-08	4-01-04	2 x 4		1-04-08 4-01-04	31.44 20.67		
	2	C40 Jack-Open	6 / 12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	28.26 17.33		
	2	C41 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	23.16 14.67		
	3	C42 Jack-Open	6 / 12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	28.71 18.00		
	3	C43 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	21.08 14.00		
	2	C44 Jack-Open	6 / 12	3-09-07	3-00-12	2 x 4	1-03-08 1-01-01	1-02-00 3-00-12	25.98 16.00		
	2	C45 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 3-01-01	1-02-00 2-00-12	20.88 13.33		
	1	C46 Jack-Open	6 / 12	1-07-08	3-00-12	2 x 4	1-10-15	1-03-08 2-01-04	7.46 5.33		

 TAMARACK ROOF TRUSSES INC. ALFA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 6 Lot #: 175 Elevation: 3- STD OR OPT.5 BR	Job Track: 51225 PlanLog: 202419 Layout ID: 408224 Ref # Page: 3 of 3 Date: 04-27-2020 Designer: Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	C47 Jack-Open	6 /12	1-07-08	2-00-12	2 x 4		1-03-08 2-01-04	4.91 3.33		

TOTAL # TRUSS= 77 TOTAL BFT OF ALL TRUSSES= 2730.33 BFT. TOTAL WEIGHT OF ALL TRSSES 4346.93 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS26-2	
1	Hardware	LJS26DS	
14	Hardware	LUS24	
2	Hardware	LUS26-2	



TOTAL NUMBER OF
ITEMS= 18

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T1	1	2	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:04 2020 Page 1

ID:DMCubINVR6TsIFoe31v6I zns11-Jm9J91AhZ22g2EEminZsEz3HTHi?mEdCAUuvczMFIf

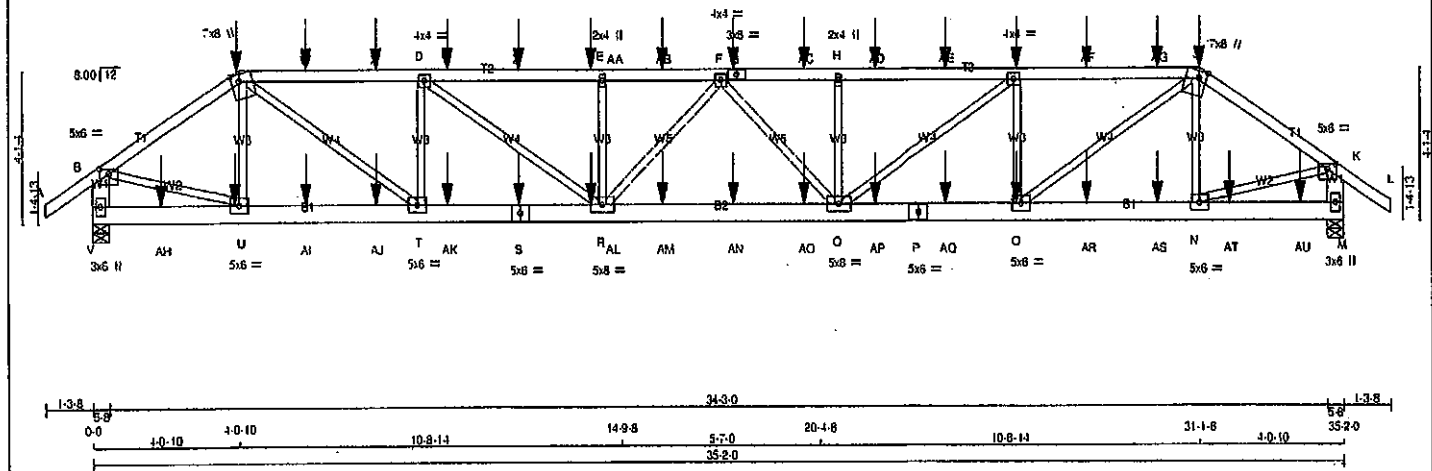

TOTAL WEIGHT = 2 X 181 = 323 lb

LUMBER	SIZE	LUMBER	DESCR.
N.L.G.A. RULES			
CHORDS	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
J - L	2x4	DRY	No.2
V - B	2x6	DRY	No.2
M - K	2x6	DRY	No.2
V - S	2x6	DRY	No.2
S - P	2x6	DRY	No.2
P - M	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 1	12	SIDE (61.0)
C - G 1	12	SIDE (61.0)
G - J 1	12	SIDE (61.0)
J - L 1	12	SIDE (61.0)
V - B 2	12	TOP
M - K 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
V - S 2	12	SIDE (183.1)
S - P 2	12	SIDE (183.1)
P - M 2	12	SIDE (183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UPLIFT	IN-SX
V	3393	0	0	5-8
M	3342	0	0	5-8

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
V	2397	1585
M	2383	1555

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.11 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	W E B S	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 35	-91.8 -91.8 0.07 (1)	U-C	-620 0
B-C	-4024 0	-91.8 -91.8 0.22 (1)	O-T	0 3359
C-W	-6074 0	-91.8 -91.8 0.53 (1)	T-D	-1848 0
W-X	-6074 0	-91.8 -91.8 0.53 (1)	O-I	-1869 0
X-O	-6074 0	-91.8 -91.8 0.53 (1)	O-J	0 3425
D-Y	-7423 0	-91.8 -91.8 0.83 (1)	N-J	-601 0
Y-Z	-7423 0	-91.8 -91.8 0.83 (1)	B-U	0 3437
Z-AA	-7423 0	-91.8 -91.8 0.83 (1)	N-K	0 3371
AA-E	-7423 0	-91.8 -91.8 0.83 (1)	O-I	0 1704
E-AB	-7423 0	-91.8 -91.8 0.35 (1)	O-R	0 1677
AB-F	-7423 0	-91.8 -91.8 0.35 (1)	Q-H	-595 0
F-G	-7410 0	-91.8 -91.8 0.36 (1)	R-E	-594 0
G-AC	-7410 0	-91.8 -91.8 0.36 (1)	R-F	-285 0
AC-H	-7410 0	-91.8 -91.8 0.36 (1)	F-Q	-305 0
H-AD	-7410 0	-91.8 -91.8 0.61 (1)		
AD-AE	-7410 0	-91.8 -91.8 0.61 (1)		
AE-I	-7410 0	-91.8 -91.8 0.61 (1)		
I-AF	-6040 0	-91.8 -91.8 0.51 (1)		
AF-AG	-6040 0	-91.8 -91.8 0.51 (1)		
AG-J	-6040 0	-91.8 -91.8 0.51 (1)		
J-K	-3946 0	-91.8 -91.8 0.22 (1)		
K-L	0 35	-91.8 -91.8 0.07 (1)		
V-B	-3355 0	0.0 0.0 0.12 (1)		
M-K	-3296 0	0.0 0.0 0.12 (1)		

V-AH	0 0	-18.5 -18.5 0.04 (4)	10.00
AH-U	0 0	-18.5 -18.5 0.04 (4)	10.00
U-AI	0 3325	-18.5 -18.5 0.25 (1)	10.00
AI-AJ	0 3325	-18.5 -18.5 0.25 (1)	10.00
AJ-T	0 3325	-18.5 -18.5 0.25 (1)	10.00
T-AK	0 6074	-18.5 -18.5 0.45 (1)	10.00
AK-S	0 6074	-18.5 -18.5 0.45 (1)	10.00
S-AL	0 6074	-18.5 -18.5 0.45 (1)	10.00
AL-R	0 6074	-18.5 -18.5 0.45 (1)	10.00
R-AM	0 7813	-18.5 -18.5 0.57 (1)	10.00
AM-AN	0 7813	-18.5 -18.5 0.57 (1)	10.00
AN-AO	0 7813	-18.5 -18.5 0.57 (1)	10.00
AO-Q	0 6040	-18.5 -18.5 0.57 (1)	10.00
Q-AP	0 6040	-18.5 -18.5 0.45 (1)	10.00
AP-P	0 6040	-18.5 -18.5 0.45 (1)	10.00
P-AQ	0 6040	-18.5 -18.5 0.45 (1)	10.00
AQ-O	0 6040	-18.5 -18.5 0.45 (1)	10.00
O-AR	0 3261	-18.5 -18.5 0.25 (1)	10.00

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (11.17)
CALCULATED VERT. DEFL. (LL) = L/999 (0.23")
ALLOWABLE DEFL. (TL) = L/360 (11.17)
CALCULATED VERT. DEFL. (TL) = L/970 (0.44")

CSI: TC=0.63/1.00 (D-E:1), BC=0.57/1.00 (Q-R:1), WB=0.43/1.00 (B-U:1), SSI=0.19/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (I) (INPUT = 0.90)
JSI METAL= 0.58 (I) (INPUT = 1.00)

CONTINUED ON PAGE 2



Structural component only
DWG# T-2007602 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T1	1	2	GREEN PARK HOMES	
				TRUSS DESC.	

Tararack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:04 2020 Page 2

ID:DMCubINVR6TstF0e31v6I zns1I-Jm9J91AhZi22o2EEminZsEz3HTHi7mEdCAUuvczMFif

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW+p	MT20	5.0	6.0	1.50	3.00
C	TTWW+m	MT20	7.0	8.0	Edge	2.50
D, F, I						
D	TMW-l	MT20	4.0	4.0		
E	TMW+w	MT20	2.0	4.0		
G	TS-l	MT20	3.0	6.0		
H	TMW+w	MT20	2.0	4.0		
J	TTWW+m	MT20	7.0	8.0	Edge	2.50
K	TMW+p	MT20	5.0	6.0	1.50	3.00
M	BMV1+p	MT20	3.0	6.0		
N, O, T, U						
N	BMW-l	MT20	5.0	6.0		
P	BS-l	MT20	5.0	6.0		
Q	BMW-l	MT20	5.0	6.0		
R	BMW-l	MT20	5.0	6.0		
S	BS-l	MT20	5.0	6.0		
V	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: 14)

CHORDS				WEBS			
MEMB.	FORCE	VERT. LOAD	LC1	MAX.	MEMB.	FORCE	MAX.
(LBS)	(PLF)	(LBS)	(LBS)		(LBS)	(LBS)	
FR-TO	FROM	TO	LENGTH	FR-TO	FROM	TO	LENGTH
AR-AS	0	3261	-18.5	-18.5	0.25	(1)	10.00
AS-N	0	3261	-18.5	-18.5	0.25	(1)	10.00
N-AT	0	0	-18.5	-18.5	0.04	(4)	10.00
AT-AU	0	0	-18.5	-18.5	0.04	(4)	10.00
AU-M	0	0	-18.5	-18.5	0.04	(4)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-10	-49	-55	---	FRONT	VERT	DEAD	---	C1
C	4-0-10	-117	-117	---	FRONT	VERT	TOTAL	---	C1
C	4-0-10	-254	-254	---	FRONT	VERT	SNOW	---	C1
G	17-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
I	25-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
J	31-1-6	-49	-55	---	FRONT	VERT	DEAD	---	C1
J	31-1-6	-254	-254	---	FRONT	VERT	SNOW	---	C1
O	25-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
S	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
U	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
W	5-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	19-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	21-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	23-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	27-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AG	29-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AH	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AL	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AM	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AN	17-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	19-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AP	21-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AQ	23-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AR	27-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AS	29-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AT	31-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AU	33-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007602 3/2

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:05 2020 Page 1

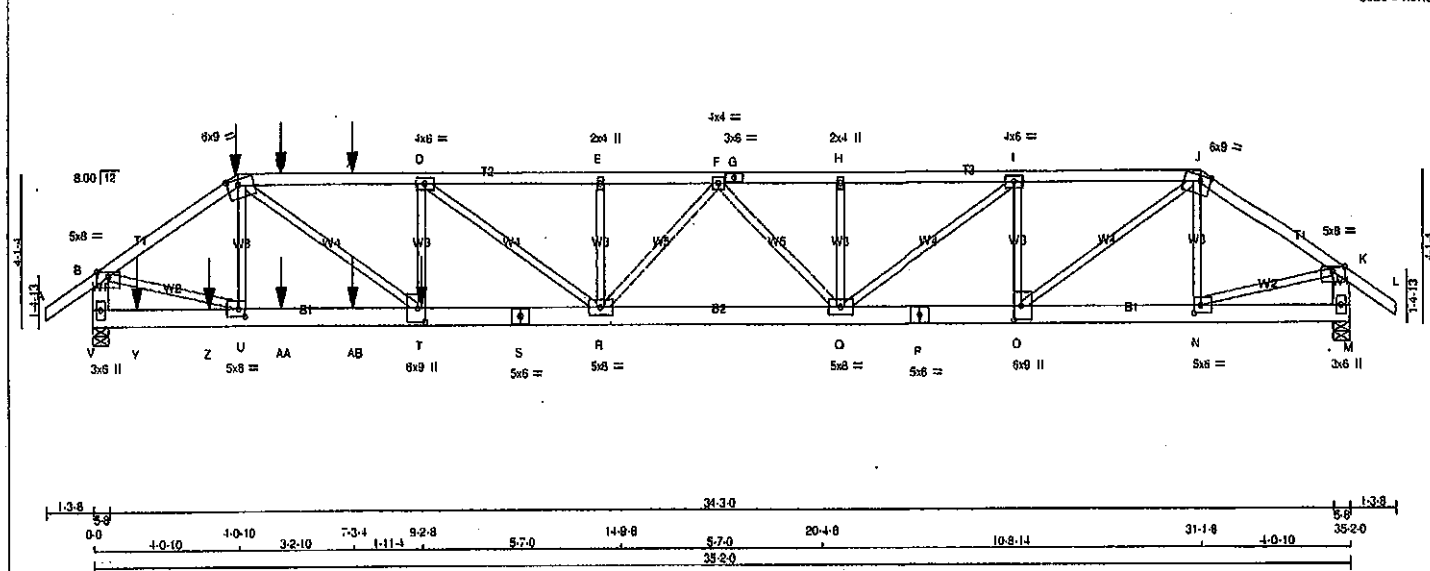

TOTAL WEIGHT = 2 X 101 = 202 [M]

LUMBER			
N.L.G.A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
J - L	2x4	DRY	No.2
V - B	2x6	DRY	No.2
M - K	2x6	DRY	No.2
V - S	2x6	DRY	No.2
S - P	2x6	DRY	No.2
P - M	2x6	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY; SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT
SEPARATELY THEN FASTENED TOGETHER AS
FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	12	SIDE(61.0)
C-G	12	SIDE(61.0)
G-J	12	TOP
J-L	12	TOP
V-B	2	TOP
M-K	2	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
V-S	2	SIDE(183.1)
S-P	2	TOP
P-M	2	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	SIDE(385.4)
D-T	4	
I-O	4	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANDGARS ARE
FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND
MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE
LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
		GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORIZ	DOWN	HORIZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
V	4215	0	4215	0	0	5-8	5-8	5-8	5-8
M	2722	0	2722	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST LOASE		MAX. MIN. COMPONENT REACTIONS		PERMALIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERMALIVE	WIND	DEAD	SOIL	JT	COMBINED	SNOW	LIVE
V	2874	1987	0	0	0	0	0	987	0	0	0
M	1921	1283	0	0	0	0	0	638	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEB S		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. CS1 (LC)	MAX. UNBRAC LENGTH FR-TO	MEMB.	FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 35	-91.8 -91.8 0.07 (1)	10.00	U-C	-783 0	0.10 (1)	
B-C	-5115 -0	-91.8 -91.8 0.28 (1)	4.07	C-T	0 4817	0.80 (1)	
C-G	-8135 -0	-91.8 -91.8 0.64 (1)	3.00	T-D	-622 0	0.08 (1)	
G-J	-8135 -0	-91.8 -91.8 0.64 (1)	3.00	O-I	-1797 -0	0.23 (1)	
J-L	-8135 -0	-91.8 -91.8 0.64 (1)	3.00	O-J	0 3211	0.40 (1)	
V-B	-8106 -0	-91.8 -91.8 0.59 (1)	3.05	N-J	-512 -0	0.08 (1)	
D-E	-8106 -0	-91.8 -91.8 0.32 (1)	3.28	B-U	0 4370	0.54 (1)	
E-F	-8106 -0	-91.8 -91.8 0.26 (1)	3.57	N-K	0 2693	0.33 (1)	
F-G	-8106 -0	-91.8 -91.8 0.26 (1)	3.57	O-I	0 2133	0.26 (1)	
G-H	-8106 -0	-91.8 -91.8 0.45 (1)	3.42	D-R	-37 24	0.01 (1)	
H-I	-8106 -0	-91.8 -91.8 0.45 (1)	3.42	O-H	-365 0	0.05 (1)	
I-J	-5210 -0	-91.8 -91.8 0.19 (1)	5.04	R-E	-343 0	0.04 (1)	
J-K	-3153 0	-91.8 -91.8 0.07 (1)	10.00	R-F	0 692	0.08 (1)	
K-L	0 35	0.0 0.0 0.15 (1)	8.99	F-Q	-1081 0	0.23 (1)	
V-B	-1890 0	0.0 0.0 0.10 (1)	7.81				
M-K	-2696 0	0.0 0.0 0.10 (1)	7.81				

V-Y	0 0	-18.5 -18.5 0.05 (4)	10.00
Y-Z	0 0	-18.5 -18.5 0.05 (4)	10.00
Z-U	0 0	-18.5 -18.5 0.05 (4)	10.00
U-AA	0 4227	-18.5 -18.5 0.35 (1)	10.00
AA-AB	0 4227	-18.5 -18.5 0.35 (1)	10.00
AB-T	0 4227	-18.5 -18.5 0.35 (1)	10.00
T-S	0 8135	-18.5 -18.5 0.61 (1)	10.00
S-R	0 8135	-18.5 -18.5 0.61 (1)	10.00
R-Q	0 7645	-18.5 -18.5 0.55 (1)	10.00
Q-P	0 5210	-18.5 -18.5 0.38 (1)	10.00
P-O	0 5210	-18.5 -18.5 0.38 (1)	10.00
O-N	0 2604	-18.5 -18.5 0.19 (1)	10.00
N-M	0 0	-18.5 -18.5 0.03 (4)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-10	-49	-55	---	FRONT	VERT	---	C1
C	4-0-10	-254	-254	---	FRONT	VERT	---	C1
T	9-2-8	-2179	-2179	---	BACK	VERT	---	C1
W	5-3-4	-110	-110	---	BACK	VERT	---	C1
X	7-3-4	-110	-110	---	BACK	VERT	---	C1
Y	1-3-4	-28	-28	---	BACK	VERT	---	C1
Z	3-3-4	-28	-28	---	BACK	VERT	---	C1
AA	5-3-4	-28	-28	---	BACK	VERT	---	C1
AB	7-3-4	-28	-28	---	BACK	VERT	---	C1

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***

GEOMETRY AND/OR BASIC LOADS CHANGED BY
USER.

LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	6.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD = 39.0 PSF				

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 6.0%/12

*** NON STANDARD GIRDER ***

ADDT'L USER-DEFINED LOADS APPLIED TO ALL
LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9.
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

ISS OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEF'L (LL) = L/360 (1.17')
CALCULATED VERT. DEF'L (LL) = L/999 (0.24')
ALLOWABLE DEF'L (TL) = L/360 (1.17')
CALCULATED VERT. DEF'L (TL) = L/954 (0.44')

CSF: TC=0.84/1.00 (C-D:1), BC=0.81/1.00 (R-T:1),
WB=0.60/1.00 (C-T:1), SS=0.17/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT
RESPONSIBLE FOR QUALITY CONTROL IN THE
TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP/DRY	SHEAR (PSI)	SECTION (PLI)
MT20	618 354 1667 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (J) INPUT = 0.90 (J)
JSI METAL = 0.77 (P) INPUT = 1.00 (J)

CONTINUED ON PAGE

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T1Z	1	2	GREEN PARK HOMES	
Taftiarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:00:05 2020 Page 2

ID:DMCvblNVR6TstFos31v6l zns1l-nvhlMNBjKcAvHCpQKTuoQRWDoscNkAonRqORR2zMFle


PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW-m	MT20	6.0	9.0	1.75	3.50
D	TMWW-l	MT20	4.0	6.0		
E	TMW+w	MT20	2.0	4.0		
F	TMWW-l	MT20	4.0	4.0		
G	TS-l	MT20	3.0	6.0		
H	TMW+w	MT20	2.0	4.0		
I	TMWW-l	MT20	4.0	6.0		
J	TTWW-m	MT20	6.0	9.0	1.75	3.50
K	TMVW-p	MT20	5.0	8.0	Edge	
M	BMV1+p	MT20	3.0	6.0		
N	BMWW-l	MT20	5.0	6.0	2.50	2.25
O	BMWW-l	MT20	6.0	9.0	4.50	2.50
P	BS-l	MT20	5.0	6.0		
Q	BMWW-l	MT20	5.0	6.0		
R	BMWW-l	MT20	5.0	6.0		
S	BS-l	MT20	5.0	6.0		
T	BMWW-l	MT20	6.0	9.0	4.50	2.50
U	BMWW-l	MT20	5.0	6.0	2.50	2.25
V	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

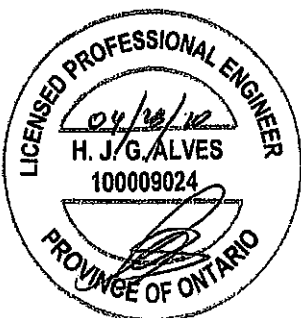

Structural component only
DWG# T-2007603 7/2



DRY, SEASONED LUMBER.	BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S. K	THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9.
-----------------------	--	--

PLATES (table is in inches) JT TYPE PLATES W LEN Y X 1 1 1 1 1 1				ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.	- PART 9 OF CBCQ 2018 , CBC 2012 , ABC 2019 - PART 9 OF CBC 2012 (19th AMENDMENT) - CBC 2018.00 , CBC 2018.14
--	--	--	--	--	---

[illegible]

N	BS-I	M20	4.0	6.0	C-D	-3213.0	-91.8	-91.8	0.80 (1)	3.19	C-D	-929.0	0.38 (1)	CSI: TC=0.86/1.00 (D-E:11, 8C=0.58/1.00 (M-O:11), WB=0.44/1.00 (L-L:1), SS=0.28/1.00 (G-H:1)	
O	BMVWW-I	M20	4.0	9.0	D-E	-3594.0	-91.8	-91.8	0.88 (1)	2.97	D-Q	0	490		0.13 (1)
P	BS-I	M20	4.0	6.0	E-F	-3594.0	-91.8	-91.8	0.88 (1)	2.97	C-E	-505.0	0.19 (1)		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.	S-B	-2023	0	0.0	0.0	0.21 (1)	5.94	B-R	0	1843	0.44 (1)	COMPANION LIVE LOAD FACTOR = 1.00
	K-I	-2023	0	0.0	0.0	0.21 (1)	5.94	L-I	0	1943	0.44 (1)	

NAIL VALUES				
PLATE	GRIP(DRY)	SHEAR	SECTION	
	DBH	DBH	DBH	DBH
O-N	0 3213	-18.5	-18.5	0.58 (1) 10.00
N-M	0 3213	-18.5	-18.5	0.58 (1) 10.00
N-L	0 1802	-18.5	-18.5	0.50 (1) 10.00

ED PRO... ENGINE

100009024


		
---	--	--

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65
66
67
68
69
70
71
72
73
74
75
76
77
78
79
80
81
82
83
84
85
86
87
88
89
90
91
92
93
94
95
96
97
98
99
100
101
102
103
104
105
106
107
108
109
110
111
112
113
114
115
116
117
118
119
120
121
122
123
124
125
126
127
128
129
130
131
132
133
134
135
136
137
138
139
140
141
142
143
144
145
146
147
148
149
150
151
152
153
154
155
156
157
158
159
160
161
162
163
164
165
166
167
168
169
170
171
172
173
174
175
176
177
178
179
180
181
182
183
184
185
186
187
188
189
190
191
192
193
194
195
196
197
198
199
200
201
202
203
204
205
206
207
208
209
210
211
212
213
214
215
216
217
218
219
220
221
222
223
224
225
226
227
228
229
230
231
232
233
234
235
236
237
238
239
240
241
242
243
244
245
246
247
248
249
250
251
252
253
254
255
256
257
258
259
260
261
262
263
264
265
266
267
268
269
270
271
272
273
274
275
276
277
278
279
280
281
282
283
284
285
286
287
288
289
290
291
292
293
294
295
296
297
298
299
300
301
302
303
304
305
306
307
308
309
310
311
312
313
314
315
316
317
318
319
320
321
322
323
324
325
326
327
328
329
330
331
332
333
334
335
336
337
338
339
340
341
342
343
344
345
346
347
348
349
350
351
352
353
354
355
356
357
358
359
360
361
362
363
364
365
366
367
368
369
370
371
372
373
374
375
376
377
378
379
380
381
382
383
384
385
386
387
388
389
390
391
392
393
394
395
396
397
398
399
400
401
402
403
404
405
406
407
408
409
410
411
412
413
414
415
416
417
418
419
420
421
422
423
424
425
426
427
428
429
430
431
432
433
434
435
436
437
438
439
440
441
442
443
444
445
446
447
448
449
450
451
452
453
454
455
456
457
458
459
460
461
462
463
464



DWG# 1-2007004

JOB NAME 408222	TRUSS NAME T3	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 09:00:06 2020 Page 1	
ID:DMCubINVR6TstFoe31v6l_zns1l-F8H4ajCx5wlmvMOcuAP1x2QrG_VTXHwIUz? UzMFId				35-2-0 38-5-8 1-3-8	
-1-3-8 0-0 3-7-9 3-7-9 3-5-1 7-0-10 5-3-13 12-4-7 5-2-9 17-7-0 5-2-9 22-3-9 5-3-13 28-1-8 7-5-1 31-6-7 3-7-9 1-3-8				Scale = 1:57.6	

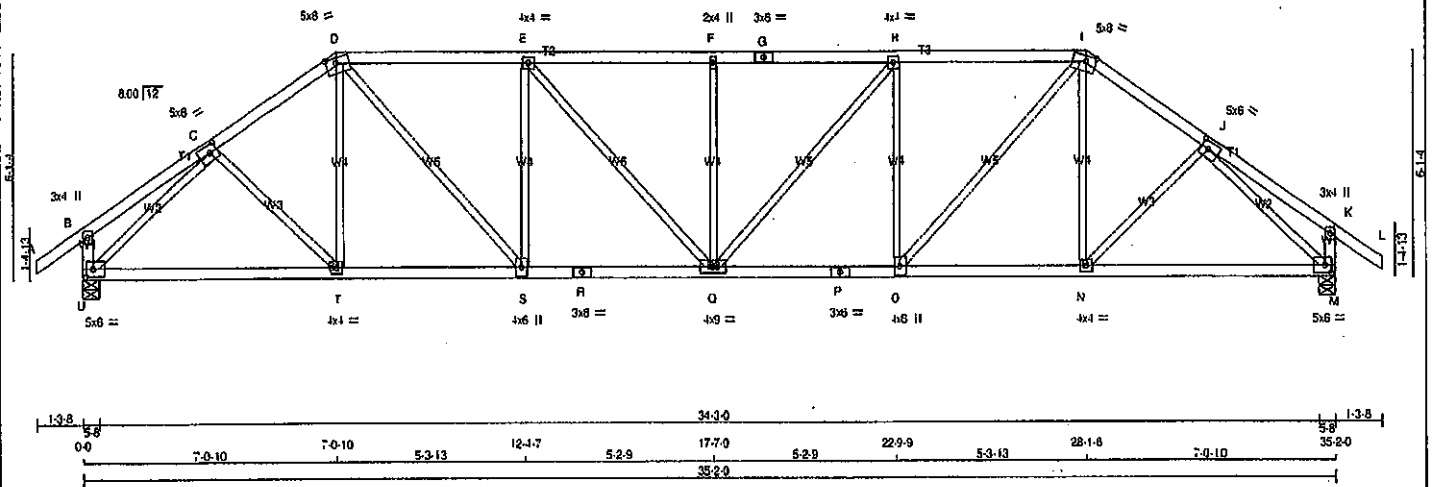

TOTAL WEIGHT = 2 X 151 = 303 lb (M)

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
U - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMWW-I	MT20	5.0	6.0	2.50 2.50
D	TTWW-m	MT20	5.0	8.0	1.75 3.50
E	TMWW-I	MT20	4.0	4.0	
F	TMWW-w	MT20	2.0	4.0	
G	TS-I	MT20	3.0	6.0	
H	TMWW-I	MT20	4.0	4.0	
I	TTWW-m	MT20	5.0	8.0	1.75 3.50
J	TMWW-I	MT20	5.0	6.0	2.50 2.50
K	TMV+p	MT20	3.0	4.0	
M	BMWW-I	MT20	5.0	8.0	2.50 2.25
N	BMWW-I	MT20	4.0	4.0	
O	BMWW-I	MT20	4.0	6.0	
P	BS-I	MT20	3.0	6.0	
Q	BMWW-I	MT20	4.0	9.0	
R	BS-I	MT20	3.0	6.0	
S	BMWW-I	MT20	4.0	6.0	
T	BMWW-I	MT20	4.0	4.0	
U	BMWW-I	MT20	5.0	6.0	2.50 2.25

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
U	2065	0	2065	0	5-8
M	2065	0	2065	0	5-8

UNFACTORED REACTIONS

		1ST LOASE	MAX. MIN.	COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
U	1458	970	0	0	0	0	488	0	0
M	1458	970	0	0	0	0	488	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.53 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)
FR-TO		FROM TO	LENGTH FR-TO	FR-TO		FROM TO	LENGTH FR-TO
A-B	0 35	-91.8	-91.8 0.12 (1)	10.00	C-T	0 135	0.03 (4)
B-C	0 18	-91.8	-91.8 0.16 (1)	10.00	T-D	0 80	0.03 (4)
C-D	-2305 0	-91.8	-91.8 0.23 (1)	4.31	D-S	0 1218	0.27 (1)
D-E	-2723 0	-91.8	-91.8 0.54 (1)	3.69	S-E	-814 0	0.48 (1)
E-F	-2968 0	-91.8	-91.8 0.56 (1)	3.53	E-Q	0 363	0.08 (1)
F-G	-2968 0	-91.8	-91.8 0.56 (1)	3.53	Q-F	-440 0	0.26 (1)
G-H	-2968 0	-91.8	-91.8 0.56 (1)	3.53	O-H	0 383	0.08 (1)
H-I	-2723 0	-91.8	-91.8 0.54 (1)	3.69	O-H	-814 0	0.48 (1)
I-J	-2305 0	-91.8	-91.8 0.23 (1)	4.31	O-I	0 1218	0.27 (1)
J-K	0 18	-91.8	-91.8 0.16 (1)	10.00	N-I	0 90	0.03 (4)
K-L	0 35	-91.8	-91.8 0.12 (1)	10.00	N-J	0 135	0.03 (4)
U-B	-255 0	0.0	0.0 0.03 (1)	7.81	U-C	-2514 0	0.97 (1)
M-K	-255 0	0.0	0.0 0.03 (1)	7.81	J-M	-2514 0	0.97 (1)

U-T	0 1801	-18.5	-18.5 0.40 (1)	10.00
T-S	0 1800	-18.5	-18.5 0.41 (1)	10.00
S-R	0 2723	-18.5	-18.5 0.49 (1)	10.00
R-Q	0 2723	-18.5	-18.5 0.49 (1)	10.00
Q-P	0 2723	-18.5	-18.5 0.49 (1)	10.00
P-O	0 2723	-18.5	-18.5 0.49 (1)	10.00
O-N	0 1800	-18.5	-18.5 0.41 (1)	10.00
N-M	0 1801	-18.5	-18.5 0.40 (1)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/998 (0.16")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/998 (0.29")

CS: TC=0.56/1.00 (E-F:1), BC=0.49/1.00 (O-C:1),
WB=0.97/1.00 (J-M:1), SS=0.23/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1867 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (M) (INPUT = 0.90)
JSI METAL = 0.84 (P) (INPUT = 1.00)




Structural component only
DWG# T-2007605

JOB NAME 408222	TRUSS NAME T4	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.				Version 8.310 S Oct 29 2019 AMTek Industries, Inc. Tue Apr 28 09:00:07 2020 Page 1	

Tamarack Roof Truss, Burlington

ID:DMCubINVR6TslFoe31v8l_zns11-LrSn2CZsDQdXWzSuzGTsbZlgK2C5T4u8YVWwzMFic

1-3.8 0.0 4.4.9 4.4.9 4.2.1 8.8-10 6.0-11 14-7.5 5-11.7 20.6-11 8.0-11 26-7.6 4.2-1 30.9-7 4.4-9 35-2.0 35.5-8 1-3.8 Scale = 1:57.6

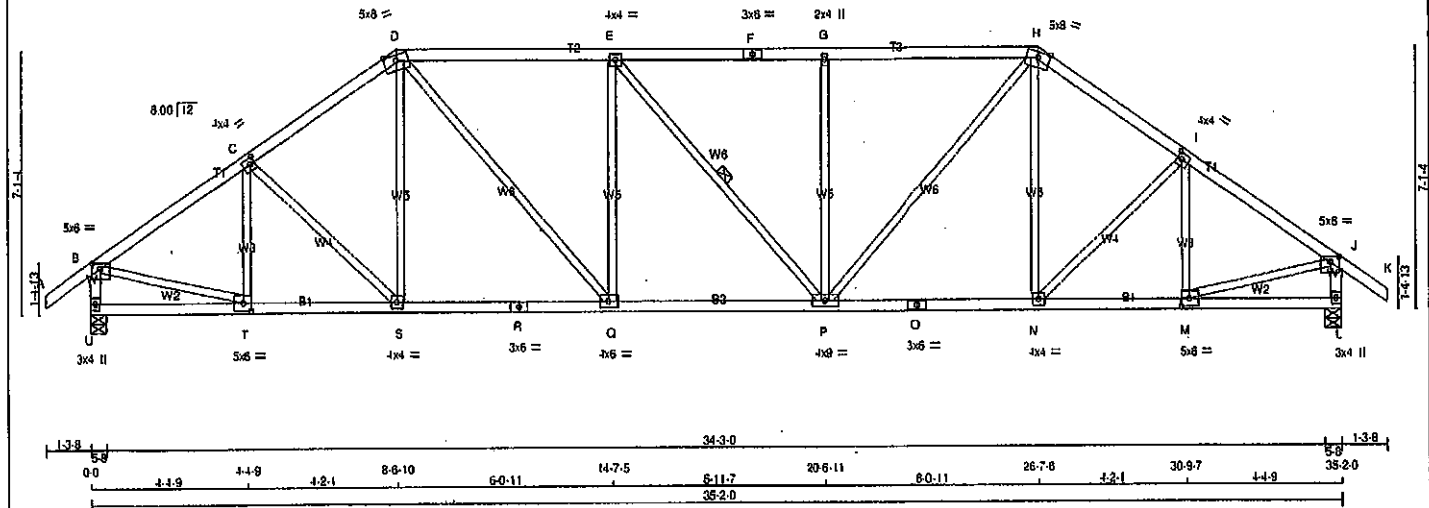

TOTAL WEIGHT = 2 X 155 = 309 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
L - J	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMWV-p	MT20	5.0	6.0	1.75 2.75
C	TMWV-l	MT20	4.0	4.0	2.00 1.50
D	TTWV-m	MT20	5.0	8.0	Edge
E	TMWV-l	MT20	4.0	4.0	Edge
F	TS-1	MT20	3.0	6.0	Edge
G	TMWV-w	MT20	2.0	4.0	Edge
H	TTWV-m	MT20	5.0	8.0	Edge
I	TMWV-l	MT20	4.0	4.0	2.00 1.50
J	TMWV-p	MT20	5.0	6.0	1.75 2.75
L	BMV1-p	MT20	3.0	4.0	2.50 2.75
M	BMWV-l	MT20	5.0	6.0	2.50 2.75
N	BMWV-l	MT20	4.0	4.0	2.50 2.75
O	BS-1	MT20	3.0	6.0	2.50 2.75
P	BMWV-l	MT20	4.0	4.0	2.50 2.75
Q	BMWV-l	MT20	4.0	4.0	2.50 2.75
R	BS-1	MT20	3.0	6.0	2.50 2.75
S	BMWV-l	MT20	4.0	4.0	2.50 2.75
T	BMWV-l	MT20	5.0	6.0	2.50 2.75
U	BMV1-p	MT20	3.0	4.0	2.50 2.75

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
U	2065	0	0	2065	0	0	5-8	5-8	5-8
L	2065	0	0	2065	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
U	1458	970	0	0	0	0	0
L	1458	970	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1.2 LENGTH OF E-F.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		FACTORED		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT.	LOAD (PLF)	MAX	UNBRAC	MEMB.	FORCE (LBS)	MAX	UNBRAC	MEMB.	FORCE (LBS)
FR-TO						FR-TO				FR-TO	
A-B	0 35	-91.8	-91.8	0.12 (1)	10.00	T-C	-397 0	0.11 (1)			
B-C	-2269 0	-91.8	-91.8	0.37 (1)	4.19	C-S	-78 0	0.05 (1)			
C-D	-2254 0	-91.8	-91.8	0.36 (1)	4.21	S-D	0 155	0.04 (4)			
D-E	-2485 0	-91.8	-91.8	0.64 (1)	3.72	D-Q	0 949	0.21 (1)			
E-F	-2483 0	-91.8	-91.8	0.64 (1)	3.72	Q-E	-597 0	0.52 (1)			
F-G	-2483 0	-91.8	-91.8	0.64 (1)	3.72	E-P	-2 0	0.00 (1)			
G-H	-2483 0	-91.8	-91.8	0.63 (1)	3.74	P-Q	-597 0	0.52 (1)			
H-I	-2254 0	-91.8	-91.8	0.36 (1)	4.21	P-H	0 947	0.21 (1)			
I-J	-2269 0	-91.8	-91.8	0.37 (1)	4.19	N-I	0 157	0.04 (4)			
J-K	0 35	-91.8	-91.8	0.12 (1)	10.00	N-I	-78 0	0.05 (1)			
U-B	-2027 0	0.0	0.0	0.21 (1)	5.94	M-I	-397 0	0.11 (1)			
L-J	-2026 0	0.0	0.0	0.21 (1)	5.94	S-T	0 1935	0.44 (1)			
						M-J	0 1935	0.44 (1)			
U-T	0 0	-18.5	-18.5	0.08 (4)	10.00						
T-S	0 1908	-18.5	-18.5	0.37 (1)	10.00						
S-R	0 1853	-18.5	-18.5	0.36 (1)	10.00						
R-Q	0 1853	-18.5	-18.5	0.36 (1)	10.00						
Q-P	0 2485	-18.5	-18.5	0.47 (1)	10.00						
P-O	0 1854	-18.5	-18.5	0.36 (1)	10.00						
O-N	0 1854	-18.5	-18.5	0.36 (1)	10.00						
N-M	0 1908	-18.5	-18.5	0.37 (1)	10.00						
M-L	0 0	-18.5	-18.5	0.08 (4)	10.00						

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')

CALCULATED VERT. DEFL.(LL) = L/999 (0.12')

ALLOWABLE DEFL.(TL) = L/360 (1.17')

CALCULATED VERT. DEFL.(TL) = L/999 (0.24')

CSI: TC=0.64/1.00 (D-E:1), BC=0.47/1.00 (P-Q:1), WB=0.52/1.00 (E-Q:1), SS=0.26/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1997 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (D) (INPUT = 0.90)
JSI METAL= 0.62 (Q) (INPUT = 1.00)



Structural component only
DWG# T-2007606


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T5	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 09:00:08 2020 Page 1

ID:DMCubINVR6TsIFoe31v6l_zns11-BXPq ODBdXYU8IY??bRV048IM4gExZrD7oSS2NzMFIt

1-3.8 0-0 5-1.9 5-1.9 4-11.1 10-0-10 7-6.6 17-7-0 7-6.6 25-1-6 4-11-1 30-0-7 5-1-9 1-3.8
Scale = 1:57.6

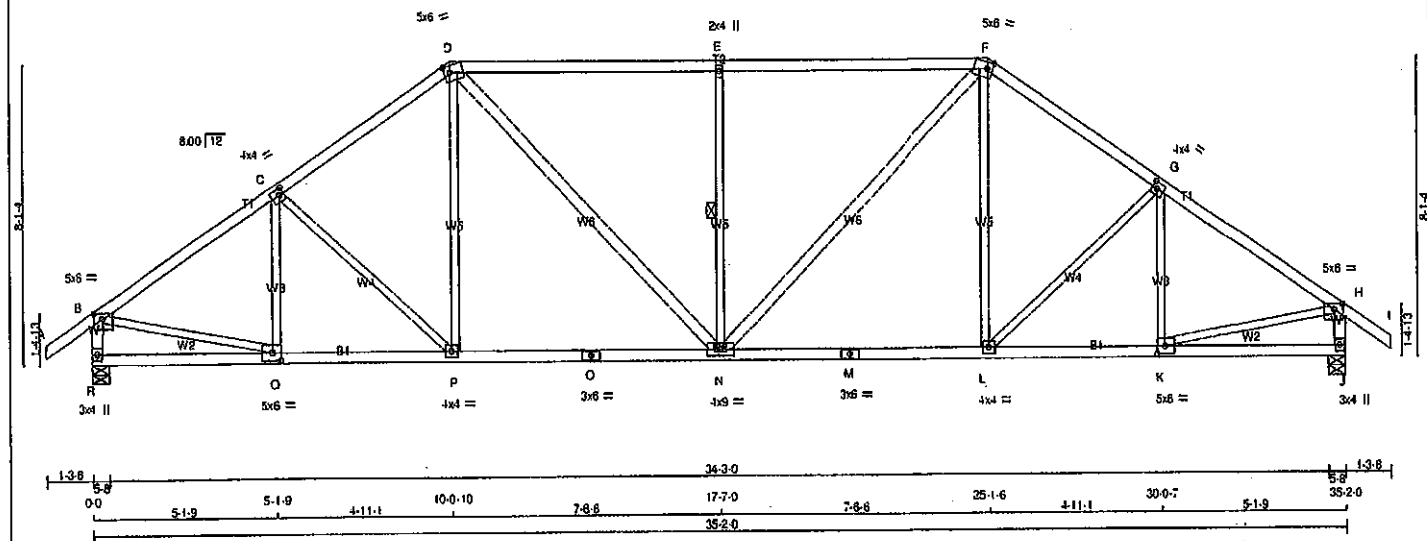

TOTAL WEIGHT = 2 X 158 = 317 lb (MIP)

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
R - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
R - O	2x4	DRY	No.2	SPF
O - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
D - N	2x4	DRY	No.2	SPF
N - F	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TTWW-m	MT20	5.0	6.0	2.25	1.75
E	TMVW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.25	1.75
G	TMVW-i	MT20	4.0	4.0	2.00	1.50
H	TMVW-p	MT20	5.0	6.0	1.75	2.75
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-i	MT20	5.0	6.0	2.50	2.75
L	BMVW-i	MT20	4.0	4.0		
M	BS-1	MT20	3.0	6.0		
N	BMVWVW-1	MT20	4.0	9.0		
O	BS-1	MT20	3.0	6.0		
P	BMVWVW-1	MT20	4.0	4.0		
Q	BMVW-i	MT20	5.0	6.0	2.50	2.75
R	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	UP	BRG	IN-SX	BRG	IN-SX
R	2085	0	2085	0	0	5-8	5-8	5-8	5-8
J	2085	0	2085	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1458	970	0	0	0	0	488	0
J	1458	970	0	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO			
A-B	0 35	-91.8 -91.8 0.12 (1)	10.00	Q-C	-321 0	0.11 (1)	
B-C	-2317 0	-91.8 -91.8 0.38 (1)	4.16	C-P	-218 0	0.18 (1)	
C-D	-2185 0	-91.8 -91.8 0.37 (1)	4.28	P-D	0 266	0.08 (1)	
D-E	-2274 0	-91.8 -91.8 0.81 (1)	3.47	D-N	0 691	0.11 (1)	
E-F	-2274 0	-91.8 -91.8 0.81 (1)	3.47	N-E	-851 0	0.35 (1)	
F-G	-2185 0	-91.8 -91.8 0.37 (1)	4.28	N-F	0 691	0.11 (1)	
G-H	-2317 0	-91.8 -91.8 0.38 (1)	4.16	L-F	0 266	0.08 (1)	
H-I	0 35	-91.8 -91.8 0.12 (1)	10.00	L-G	-218 0	0.18 (1)	
R-B	-2022 0	0.0 0.0 0.21 (1)	5.94	K-G	-321 0	0.11 (1)	
J-H	-2022 0	0.0 0.0 0.21 (1)	5.94	B-Q	0 1955	0.45 (1)	
				K-H	0 1955	0.45 (1)	
R-Q	0 0	-18.5 -18.5 0.10 (4)	10.00				
Q-P	0 1953	-18.5 -18.5 0.40 (1)	10.00				
P-O	0 1794	-18.5 -18.5 0.41 (1)	10.00				
O-N	0 1794	-18.5 -18.5 0.41 (1)	10.00				
N-M	0 1794	-18.5 -18.5 0.41 (1)	10.00				
M-L	0 1794	-18.5 -18.5 0.41 (1)	10.00				
L-K	0 1953	-18.5 -18.5 0.40 (1)	10.00				
K-J	0 0	-18.5 -18.5 0.10 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

GSI TC=0.81:1.00 (E:F:1), SC=0.41:1.00 (L:N:1), WB=0.45:1.00 (H:K:1), SSI=0.34:1.00 (D:E:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.87 (H) (INPUT = 0.90)
JSI METAL = 0.84 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007607

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T6	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:09 2020 Page 1
 ID:DMCubINVR6TstFoe31v6I_zns11-tyCCkEpOrgLmp6BZlykZHqkU0nq01MLSBlapzMF1a
 1-3.8 0-0 5-10.9 5-10.9 5-8.1 11-6-10 6-0-6 17-7-0 6-0-6 23-7-6 5-8.1 29-3-7 5-10.9 35-2-0 1-3.8
 Scale = 1:57.6

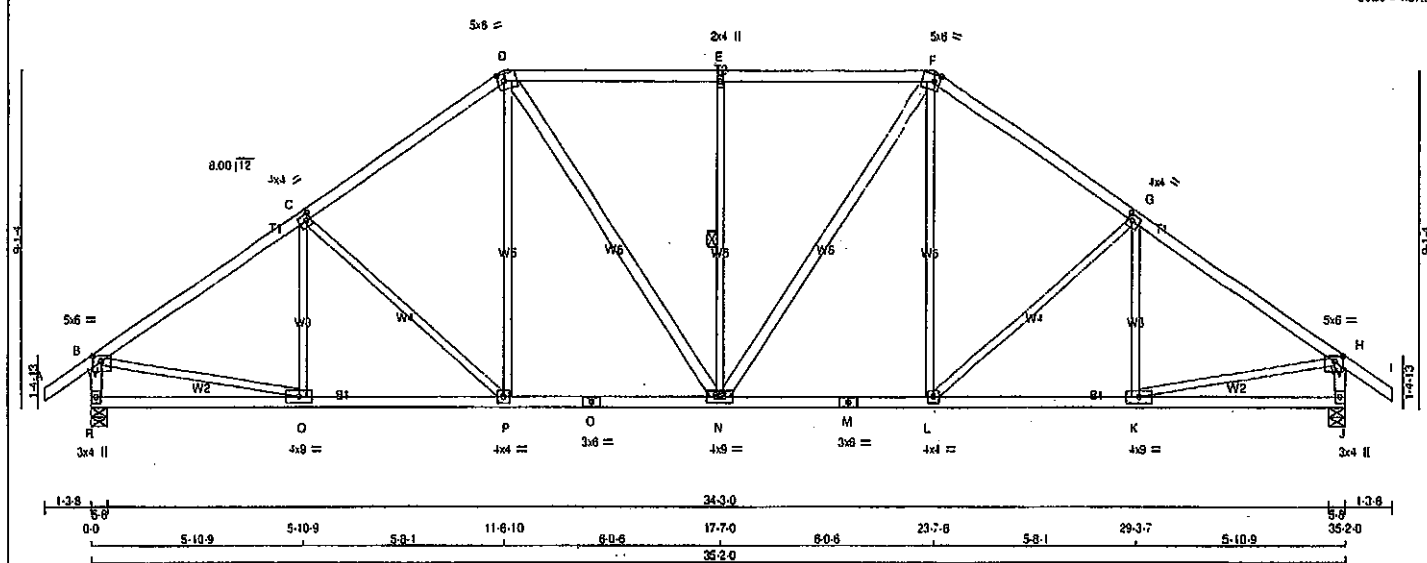

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - F	2x4	DRY	No.2	SPF		
F - I	2x4	DRY	No.2	SPF		
I - B	2x4	DRY	No.2	SPF		
B - H	2x4	DRY	No.2	SPF		
H - O	2x4	DRY	No.2	SPF		
O - M	2x4	DRY	No.2	SPF		
M - J	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						
D - N	2x4	DRY	No.2	SPF		
N - F	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (tablets in inches)	JT TYPE	PLATES	W.	LEN	Y	X
B	TMWW-p	MT20	5.0	8.0	1.75	2.75
C	TMWW-l	MT20	4.0	4.0	2.00	1.50
D	TTWW-m	MT20	5.0	8.0	2.25	2.00
E	TMWW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	8.0	2.25	2.00
G	TMWW-l	MT20	4.0	4.0	2.00	1.50
H	TMWW-p	MT20	5.0	8.0	1.75	2.75
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-l	MT20	4.0	9.0		
L	BMVW-l	MT20	4.0	4.0		
M	BS-1	MT20	3.0	6.0		
N	BMVW-w	MT20	4.0	9.0		
O	BS-1	MT20	3.0	6.0		
P	BMVW-l	MT20	4.0	4.0		
Q	BMVW-l	MT20	4.0	9.0		
R	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
R	2065	0	2065	0	5-8
J	2065	0	2065	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1458	970	0	0:0	0:0	0	488	0
J	1458	970	0	0:0	0:0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.99 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT.	LOAD (PLF)	MAX	CS1 (LC)	MEMB.	FORCE (LBS)	MAX	CS1 (LC)
FR-TO		FROM	TO			FR-TO			
A-B	0	-91.8	-91.8	0.12 (1)	10.00	Q-C	-249	11	0.11 (1)
B-C	-2348	0	-91.8	-91.8	0.52 (1)	3.99	C-P	-356	0
C-D	-2095	0	-91.8	-91.8	0.48 (1)	4.22	P-D	0	341
D-E	-1985	0	-91.8	-91.8	0.49 (1)	4.26	D-N	0	477
E-F	-1985	0	-91.8	-91.8	0.49 (1)	4.26	N-E	-678	0
F-G	-2095	0	-91.8	-91.8	0.48 (1)	4.22	N-F	0	477
G-H	-2348	0	-91.8	-91.8	0.52 (1)	3.99	L-F	0	341
H-I	0	35	-91.8	-91.8	0.12 (1)	10.00	L-G	-356	0
R-B	-2018	0	0.0	0.0	0.21 (1)	5.94	K-G	-249	11
J-H	-2018	0	0.0	0.0	0.21 (1)	5.94	B-Q	0	2014
R-Q	0	0	-18.5	-18.5	0.14 (4)	10.00	K-H	0	2014
Q-P	0	1980	-18.5	-18.5	0.39 (1)	10.00			
P-O	0	1718	-18.5	-18.5	0.34 (1)	10.00			
O-N	0	1718	-18.5	-18.5	0.34 (1)	10.00			
N-M	0	1718	-18.5	-18.5	0.34 (1)	10.00			
M-L	0	1718	-18.5	-18.5	0.34 (1)	10.00			
L-K	0	1991	-18.5	-18.5	0.39 (1)	10.00			
K-J	0	0	-18.5	-18.5	0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2015, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 26.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.19")

CS1: TC=0.52/1.00 (G-H:1), BC=0.39/1.00 (K-L:1), WB=0.45/1.00 (H-K:1), SS=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (H) INPUT = 0.90
 JSI METAL = 0.56 (H) INPUT = 1.00

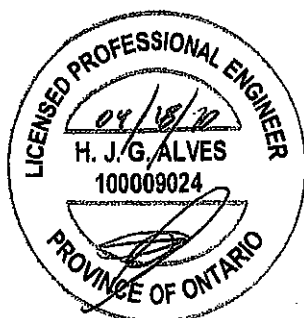


Structural component only
 DWG# T-2007608

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T7	6	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310.5 Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:10 2020 Page 1

ID:DMCubINVR6Ts1Foe31v6l_zns11-7wWp4FR98qCOzh070Uz5VD4qtMXPTGWa6xC7FzMFIZ

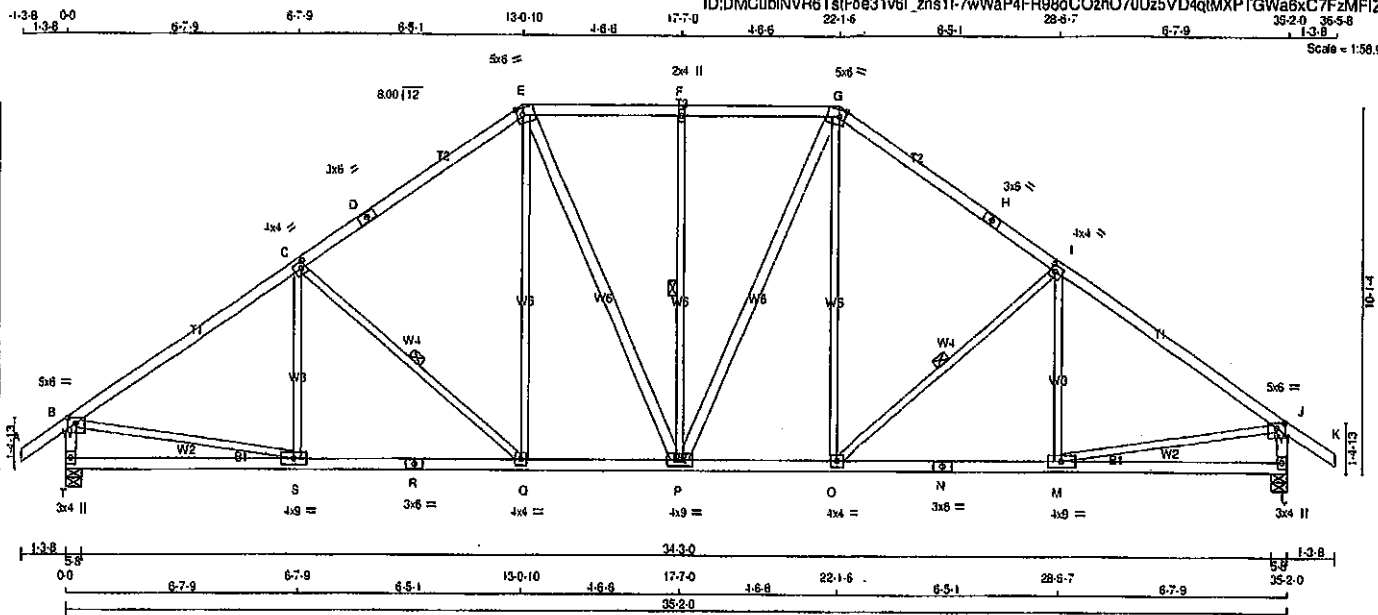


TOTAL WEIGHT = 6 X 172 = 1030 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DRY
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
T - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
T - R	2x4	DRY	No.2
R - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
E - P	2x4	DRY	No.2
P - G	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TMVW-l	MT20	4.0	4.0	2.00	1.50
D	TS-1	MT20	3.0	6.0		
E	TTWW-m	MT20	5.0	6.0	2.25	2.00
F	TMVW-w	MT20	2.0	4.0		
G	TTWW-m	MT20	5.0	6.0	2.25	2.00
H	TS-1	MT20	3.0	6.0		
I	TMVW-l	MT20	4.0	4.0	2.00	1.50
J	TMVW-p	MT20	5.0	6.0	1.75	2.75
L	BMV1+p	MT20	3.0	4.0		
M	BMVW-l	MT20	4.0	9.0		
N	BS-1	MT20	3.0	6.0		
O	BMVW-l	MT20	4.0	4.0		
P	BMVW-l	MT20	4.0	9.0		
Q	BMVW-l	MT20	4.0	4.0		
R	BS-1	MT20	3.0	6.0		
S	BMVW-l	MT20	4.0	9.0		
T	BMV1+p	MT20	3.0	4.0		

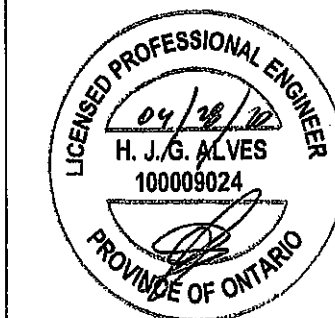

Structural component only
DWG# T-2007609

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS								
FACTORED			MAXIMUM FACTORED			INPUT	RECORD	
GROSS REACTION			GROSS REACTION			BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
T	2065	0	2065	0	0	5-8	5-8	
L	2065	0	2065	0	0	5-8	5-8	

UNFACTORED REACTIONS

1ST LOOSE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
T	1458	970	0	0	0	0	0
L	1458	970	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-Q, F-P, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	UNBRACED LENGTH
FR-TO		FROM	TO	FR-TO			
A-B	0 35	-91.8	-91.8 0.12 (1)	10.00	S-C	-189 46	0.10 (1)
B-C	-2358 0	-91.8	-91.8 0.89 (1)	3.77	C-Q	-484 0	0.24 (1)
C-D	-1996 0	-91.8	-91.8 0.82 (1)	4.11	Q-E	0 415	0.09 (1)
D-E	-1996 0	-91.8	-91.8 0.82 (1)	4.11	E-P	0 315	0.05 (1)
E-F	-1781 0	-91.8	-91.8 0.27 (1)	4.77	P-F	-502 0	0.35 (1)
F-G	-1781 0	-91.8	-91.8 0.27 (1)	4.77	P-G	0 315	0.05 (1)
G-H	-1996 0	-91.8	-91.8 0.82 (1)	4.11	O-G	0 415	0.09 (1)
H-I	-1996 0	-91.8	-91.8 0.82 (1)	4.11	O-I	-484 0	0.24 (1)
I-J	-2358 0	-91.8	-91.8 0.89 (1)	3.77	M-I	-189 46	0.10 (1)
J-K	0 35	-91.8	-91.8 0.12 (1)	10.00	B-S	0 2021	0.45 (1)
T-B	-2014 0	0.0	0.0 0.21 (1)	5.95	M-J	0 2021	0.45 (1)
L-J	-2014 0	0.0	0.0 0.21 (1)	5.95			
T-S	0 0	-18.5	-18.5 0.19 (4)	10.00			
S-R	0 1995	-18.5	-18.5 0.42 (1)	10.00			
R-Q	0 1995	-18.5	-18.5 0.42 (1)	10.00			
Q-P	0 1629	-18.5	-18.5 0.32 (1)	10.00			
P-O	0 1629	-18.5	-18.5 0.32 (1)	10.00			
O-N	0 1995	-18.5	-18.5 0.42 (1)	10.00			
N-M	0 1995	-18.5	-18.5 0.42 (1)	10.00			
M-L	0 0	-18.5	-18.5 0.19 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, A8C 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (11.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.09")
ALLOWABLE DEFL. (TL) = L/360 (11.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.18")

CS: TC=0.69:1.00 (I-J:1), BC=0.42:1.00 (M-O:1), WB=0.45:1.00 (J-K:1), SS=0.24:1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (J) (INPUT = 0.80)
JSI METAL= 0.67 (N) (INPUT = 1.00)


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T8	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:00:10 2020 Page 1

ID:DMCubINVR6TstF0e31v61_zns11-7wWwP4FR98oCOzhO70Uz5VD1gIM2PTGwa6xC7FzMFIZ

Scale: 3/16"=1'

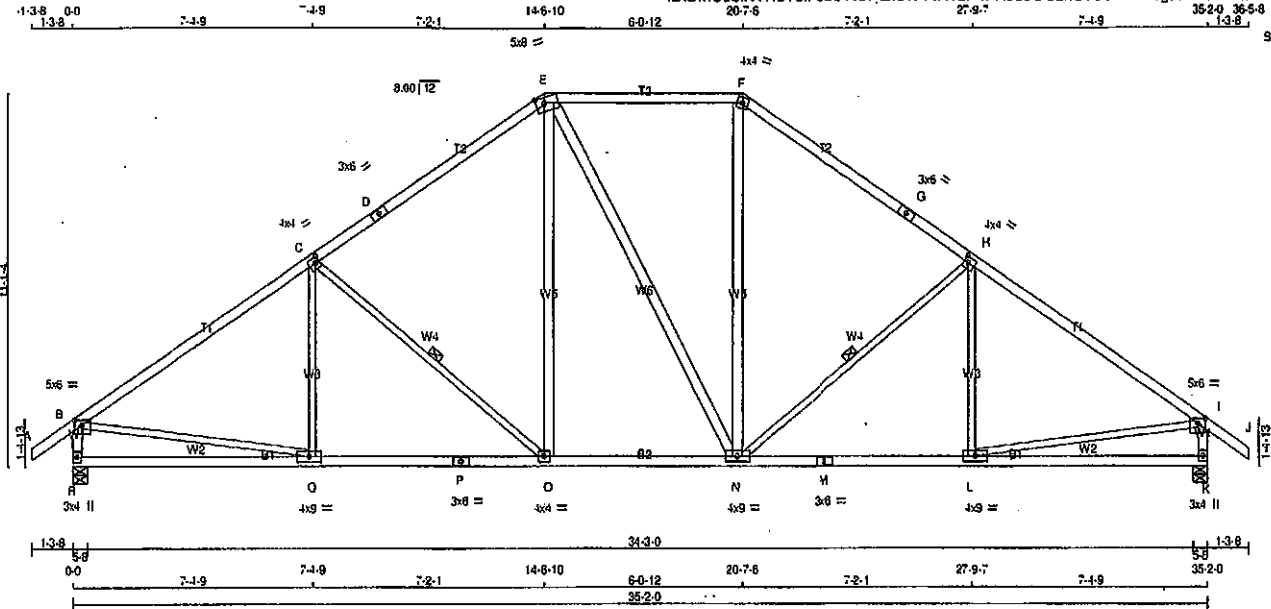

TOTAL WEIGHT = 2 X 166 = 333 lb

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - E	2x4	DRY No.2	SPF
E - F	2x4	DRY No.2	SPF
F - G	2x4	DRY No.2	SPF
G - J	2x4	DRY No.2	SPF
J - B	2x4	DRY No.2	SPF
K - I	2x4	DRY No.2	SPF
R - P	2x4	DRY No.2	SPF
P - M	2x4	DRY No.2	SPF
M - K	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF
O - E	2x4	DRY No.2	SPF
E - N	2x4	DRY No.2	SPF
N - F	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TMVW-l	MT20	4.0	4.0	2.00	1.50
D	TS-l	MT20	3.0	6.0		
E	TTW-m	MT20	5.0	8.0	2.00	3.00
F	TTW-m	MT20	4.0	4.0		
G	TS-l	MT20	3.0	6.0		
H	TMVW-l	MT20	4.0	4.0	2.00	1.50
I	TMVW-p	MT20	5.0	6.0	1.75	2.75
K	BMV-l	MT20	3.0	4.0		
L	BMVW-l	MT20	4.0	9.0		
M	BS-l	MT20	3.0	6.0		
N	BMVW-l	MT20	4.0	9.0		
O	BMVW-l	MT20	4.0	4.0		
P	BS-l	MT20	3.0	6.0		
Q	BMVW-l	MT20	4.0	9.0		
R	BMV-l	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UPLIFT	IN-SX
R	2065	0	5-8	5-8
K	2065	0	5-8	5-8

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
R	1458	970 0 0 0 0 0 488 0 0 0
K	1458	970 0 0 0 0 0 488 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.45 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX	MAX	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	CS1 (LC) UNBRAC	MEMB.	FORCE (LBS) MAX
FR-TO					FR-TO	
A-B	0 35	-91.8	-91.8 0.12 (1)	10.00	Q-C	-140 78 0.09 (1)
B-C	-2357 0	-91.8	-91.8 0.89 (1)	3.45	C-O	-604 0 0.38 (1)
C-D	-1888 0	-91.8	-91.8 0.78 (1)	3.91	O-E	0 499 0.08 (1)
D-E	-1888 0	-91.8	-91.8 0.78 (1)	3.91	E-N	0 0 0.00 (1)
E-F	-1538 0	-91.8	-91.8 0.47 (1)	4.74	N-F	0 500 0.08 (1)
F-G	-1888 0	-91.8	-91.8 0.78 (1)	3.91	H-N	-604 0 0.38 (1)
G-H	-1888 0	-91.8	-91.8 0.78 (1)	3.91	L-H	-140 75 0.09 (1)
H-I	-2357 0	-91.8	-91.8 0.89 (1)	3.45	B-Q	0 2020 0.45 (1)
I-J	0 35	-91.8	-91.8 0.12 (1)	10.00	L-I	0 2019 0.45 (1)
R-B	-2009 0	0.0	0.0 0.21 (1)	5.95		
K-I	-2009 0	0.0	0.0 0.21 (1)	5.95		
R-Q	0 0	-18.5	-18.5 0.25 (4)	10.00		
Q-P	0 1998	-18.5	-18.5 0.45 (1)	10.00		
P-O	0 1998	-18.5	-18.5 0.45 (1)	10.00		
O-N	0 1538	-18.5	-18.5 0.33 (1)	10.00		
N-M	0 1998	-18.5	-18.5 0.45 (1)	10.00		
M-L	0 1998	-18.5	-18.5 0.45 (1)	10.00		
L-K	0 0	-18.5	-18.5 0.24 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (1.17)
CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CS1: TC=0.89/1.00 (B-C:1), BC=0.45/1.00 (O-C:1), WB=0.45/1.00 (B-Q:1), SS=0.27/1.00 (H-K:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.80 (F) INPUT = 0.90
JSI METAL = 0.88 (P) INPUT = 1.00



Structural component only
DWG# T-2007610


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T9	1	2	TRUSS DESC.		

Tamack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:00:11 2020 Page 1

ID:DMCubINVR6TslF0e31v8I_zns11-b64ydQG4wSx377Gahj7CeimKBHhB6zlpmgmizMF1Y

1-3-8 0-0 3-9-8 3-9-8 3-7-0 7-4-8 4-10-12 12-3-4 1-9-8 4-10-12 21-11-8 3-10-8 25-10-0 1-3-8
Scale = 1:4.3

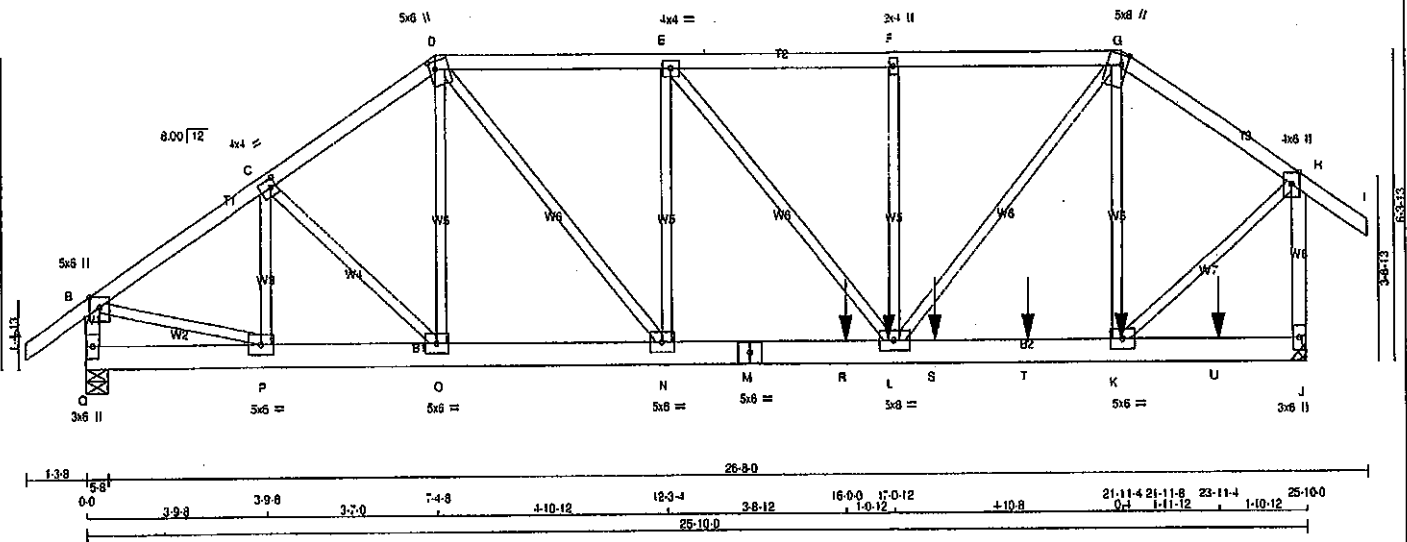

TOTAL WEIGHT = 2 X 136 = 271 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - G	2x4	DRY	No.2	SPF		
G - I	2x4	DRY	No.2	SPF		
I - B	2x4	DRY	No.2	SPF		
J - H	2x4	DRY	No.2	SPF		
Q - M	2x6	DRY	No.2	SPF		
M - J	2x6	DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : 10.122"x3" SPIRAL NAILS		
A-D 1 12		TOP
D-G 1 12		TOP
G-I 1 12		TOP
I-B 1 12		TOP
J-H 1 12		TOP
BOTTOM CHORDS : 10.122"x3" SPIRAL NAILS		
Q-M 2 12		TOP
M-J 2 12		SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1 8		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	UPLIFT	IN-SX
Q	2236	0	2236	0
J	3067	0	3067	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 4.0.

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
Q	1575	1085.0	0.0	0.0	0.0	510.0	0.0	
J	2157	1479.0	0.0	0.0	0.0	678.0	0.0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.97 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED MEMB. FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO		
A-B	0 35	-91.8	-91.8 0.07 (1)	10.00	P-C	-503 0 0.06 (1)
B-C	-2464 0	-91.8	-91.8 0.13 (1)	5.62	C-D	0 70 0.01 (1)
C-D	-2571 0	-91.8	-91.8 0.13 (1)	5.53	D-E	0 2 60 0.01 (4)
D-E	-3030 0	-91.8	-91.8 0.20 (1)	5.11	E-F	0 1433 0.18 (1)
E-F	-3235 0	-91.8	-91.8 0.21 (1)	4.97	F-G	-736 0 0.22 (1)
F-G	-3235 0	-91.8	-91.8 0.20 (1)	4.99	G-H	0 327 0.04 (1)
G-H	-3235 0	-91.8	-91.8 0.15 (1)	5.91	H-I	-169 0 0.14 (1)
H-I	0 35	-91.8	-91.8 0.07 (1)	10.00	I-J	0 2339 0.29 (1)
I-J	-2165 0	0.0	0.0 0.12 (1)	7.53	J-K	-995 0 0.30 (1)
J-K	-2362 0	0.0	0.0 0.33 (1)	6.70	K-L	0 2137 0.26 (1)
K-L	0 0	-18.5	-18.5 0.02 (1)	10.00	L-M	0 2299 0.28 (1)
L-M	0 2067	-18.5	-18.5 0.16 (1)	10.00	M-N	0 0 0.00 (1)
M-N	0 2118	-18.5	-18.5 0.22 (1)	10.00	N-O	0 0 0.00 (1)
N-O	0 3030	-18.5	-18.5 0.45 (1)	10.00	O-P	0 0 0.00 (1)
O-P	0 3030	-18.5	-18.5 0.45 (1)	10.00	P-Q	0 0 0.00 (1)
P-Q	0 3030	-18.5	-18.5 0.45 (1)	10.00	Q-R	0 0 0.00 (1)
Q-R	0 1748	-18.5	-18.5 0.27 (1)	10.00	R-S	0 0 0.00 (1)
R-S	0 1748	-18.5	-18.5 0.27 (1)	10.00	S-T	0 0 0.00 (1)
S-T	0 1748	-18.5	-18.5 0.27 (1)	10.00	T-U	0 0 0.00 (1)
T-U	0 0	-18.5	-18.5 0.08 (1)	10.00	U-V	0 0 0.00 (1)
U-V	0 0	-18.5	-18.5 0.06 (1)	10.00	V-W	0 0 0.00 (1)

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
K	21-11-4	-187	-187	---	FRONT	VERT	TOTAL	---
L	16-11-4	-187	-187	---	FRONT	VERT	TOTAL	---
R	16-0-0	-1259	-1259	---	FRONT	VERT	TOTAL	---
S	17-11-4	-187	-187	---	FRONT	VERT	TOTAL	---
T	19-11-4	-187	-187	---	FRONT	VERT	TOTAL	---
U	23-11-4	-195	-195	---	FRONT	VERT	TOTAL	---

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 23.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEF. (LL) = L/360 (0.88")
CALCULATED VERT. DEF. (LL) = L/999 (0.06")
ALLOWABLE DEF. (TL) = L/360 (0.88")
CALCULATED VERT. DEF. (TL) = L/999 (0.12")

CSK TG=0.33/1.00 (H-J:1), BC=0.45/1.00 (L-N:1), WB=0.30/1.00 (G-K:1), SS=0.35/1.00 (L-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PLI)	SECTION (PLI)
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	616 354 1887	788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.81 (H) (INPUT = 0.80)
JSI METAL= 0.53 (H) (INPUT = 1.00)



Structural component only
DWG# T-2007611 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T9	1	2	TRUSS DESC.		


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 09:00:11 2020 Page 2
ID:DMCubINVR6TsFoe31v8I zns1I-b64vdQG4wSx3?7Qah?CeimKBHhB8zifomgmizMFIY

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	Edge	
C	TMWW-l	MT20	4.0	4.0	2.00	1.50
D	TTWW+m	MT20	5.0	6.0	2.00	1.50
E	TMWW-l	MT20	4.0	4.0		
F	TMW+w	MT20	2.0	4.0		
G	TTWW+m	MT20	5.0	6.0	2.50	1.50
H	TMVW+p	MT20	4.0	6.0	Edge	
J	BMVl+p	MT20	3.0	6.0		
K, N, O, P						
K	BMWW-l	MT20	5.0	6.0		
L	BMWWW-l	MT20	5.0	6.0		
M	BS-l	MT20	5.0	6.0		
Q	BMVl+p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

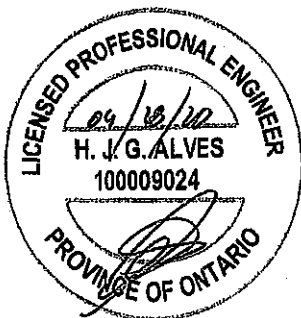

Structural component only
DWG# T-2007611

JOB NAME 408222	TRUSS NAME T10	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 \$ Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:12 2020 Page 1	

ID:DMCubINVR6TsFoe31v6I zns11-4leLqmGihm3wdHrmERWRAwLUKh4GILp2QQJB62MFIX

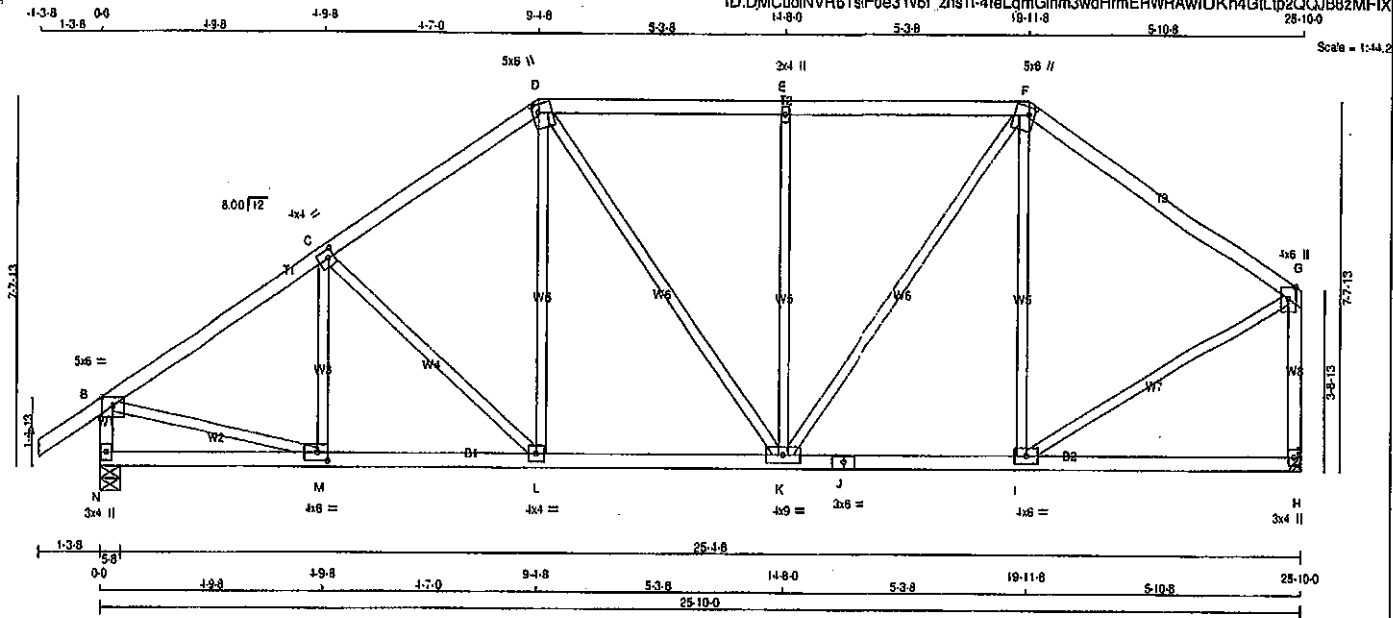

TOTAL WEIGHT = 118 lb (M/F)

LUMBER				DESCR.	
N. L. G. A. RULES	SIZE	LUMBER		SPF	
CHORDS					
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - G	2x4	DRY	No.2	SPF	
N - B	2x4	DRY	No.2	SPF	
H - G	2x4	DRY	No.2	SPF	
N - J	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge	
C	TMWW-l	MT20	4.0	4.0	2.00	1.50
D	TTVW+m	MT20	5.0	6.0	2.00	1.50
E	TMVW-w	MT20	2.0	4.0		
F	TTVW+m	MT20	5.0	6.0	2.00	1.50
G	TMVW+p	MT20	4.0	6.0	Edge	
H	BMVW-l	MT20	3.0	4.0		
I	BMWW-l	MT20	4.0	6.0		
J	BS-l	MT20	3.0	6.0		
K	BMWW-l	MT20	4.0	6.0		
L	BMWW-l	MT20	4.0	4.0		
M	BMWW-l	MT20	4.0	6.0	2.00	2.50
N	BMVW-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX
N	1550	0	1550	0	5-8	5-8
H	1424	0	1424	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE COMBINED		MAX. MIN. COMPONENT REACTIONS		LIVE	PERM. LIVE	WIND	DEAD	SOIL
	SNOW								
N	1094	731	0	0	0	0	0	363	0
H	1007	681	0	0	0	0	0	348	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.93 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	FACTORED LC1 MAX CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 35	-91.8 -91.8 0.12 (1)	10.00	M-C	-217 3	0.07 (1)	
B-C	-1609 0	-91.8 -91.8 0.29 (1)	4.93	C-L	-273 0	0.20 (1)	
C-D	-1425 0	-91.8 -91.8 0.28 (1)	5.17	L-D	0 280	0.06 (1)	
D-E	-1272 0	-91.8 -91.8 0.35 (1)	5.30	D-K	0 185	0.04 (1)	
E-F	-1272 0	-91.8 -91.8 0.35 (1)	5.30	K-E	-505 0	0.64 (1)	
F-G	-1077 0	-91.8 -91.8 0.43 (1)	5.52	K-F	0 655	0.15 (1)	
N-B	-1511 0	0.0 0.0 0.16 (1)	6.68	F-H	-380 0	0.42 (1)	
H-G	-1380 0	0.0 0.0 0.32 (1)	6.92	B-M	0 1396	0.31 (1)	
				I-G	0 1031	0.23 (1)	
N-M	0 0	-18.5 -18.5 0.09 (4)	10.00				
M-L	0 1362	-18.5 -18.5 0.27 (1)	10.00				
L-K	0 1164	-18.5 -18.5 0.24 (1)	10.00				
K-J	0 890	-18.5 -18.5 0.23 (1)	10.00				
J-I	0 890	-18.5 -18.5 0.23 (1)	10.00				
I-H	0 0	-18.5 -18.5 0.15 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9. NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.86")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.86")
CALCULATED VERT. DEFL.(TL) = L/999 (0.09")

CS1: TC=0.43/1.00 (F-G:1), BC=0.27/1.00 (L-M:1), WB=0.64/1.00 (E-K:1), SS1=0.23/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1 10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618 354 1887 788 1987 1856	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (B) (INPUT = 0.80)
JSI METAL = 0.56 (G) (INPUT = 1.00)




Structural component only
DWG# T-2007612.

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T11A	2	1	TRUSS DESC.		

Tamrack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 29 09:00:12 2020 Page 1

ID:DMCubINVR6TsfFoe31v8I_zns11-4leLqmGihm3wdHmERWRawIXHh2PIN5p2QQJ88zMFIX

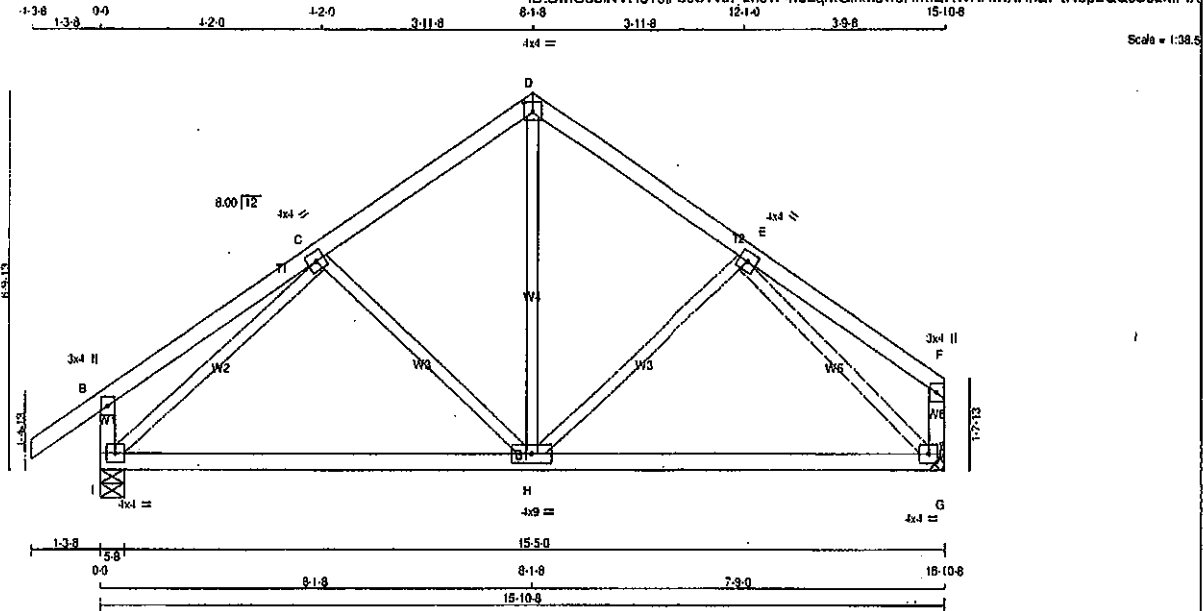

TOTAL WEIGHT = 2 X 88 = 133 lb

LUMBER	DESCR.
N. L. G. A. RULES	
CHORDS	
A - D 2x4 DRY No.2 SPF	
D - F 2x4 DRY No.2 SPF	
I - B 2x4 DRY No.2 SPF	
G - F 2x4 DRY No.2 SPF	
I - G 2x4 DRY No.2 SPF	
ALL WEBS 2x3 DRY No.2 EXCEPT	
DRY: SEASONED LUMBER.	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	GROSS REACTION	BRG	BRG
I	1001 0	1001 0	5.8	5.8
G	875 0	875 0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3'-8".

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	706	476 0	0 0	0 0	0 0	229 0	0 0
G	619	408 0	0 0	0 0	0 0	213 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 35	-91.8 -91.8 0.12 (1)	C-H	-228 0 0.12 (1)
B-C	0 24	-91.8 -91.8 0.24 (1)	H-D	0 449 0.10 (1)
C-D	-891 0	-91.8 -91.8 0.19 (1)	D-E	-168 0 0.09 (1)
D-E	-889 0	-91.8 -91.8 0.17 (1)	E-F	-989 0 0.50 (1)
E-F	0 24	-91.8 -91.8 0.22 (1)	F-G	-971 0 0.44 (1)
F-G	-289 0	0.0 0.0 0.03 (1)		
G-F	-125 0	0.0 0.0 0.01 (1)		
I-H	0 722	-18.5 -18.5 0.39 (4)		
H-G	0 877	-18.5 -18.5 0.39 (4)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GIC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.53")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.53")
CALCULATED VERT. DEFL.(TL) = L/999 (0.1")

CS: TC=0.24 (1.00 (B-C:1)), BC=0.39 (1.00 (H-I:4)), WB=0.50 (1.00 (C-I:1)), SS=0.15 (1.00 (C-D:1))

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (E) (INPUT = 0.90)
JSI METAL= 0.35 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007613

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T11B	2	1	TRUSS DESC.		

Tambrack Roof Truss, Burlington

Version 3.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:01 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns11-SxVsS1cVvDTdV3q25MsNOihBxxWB?PWsSQ4izMEMI

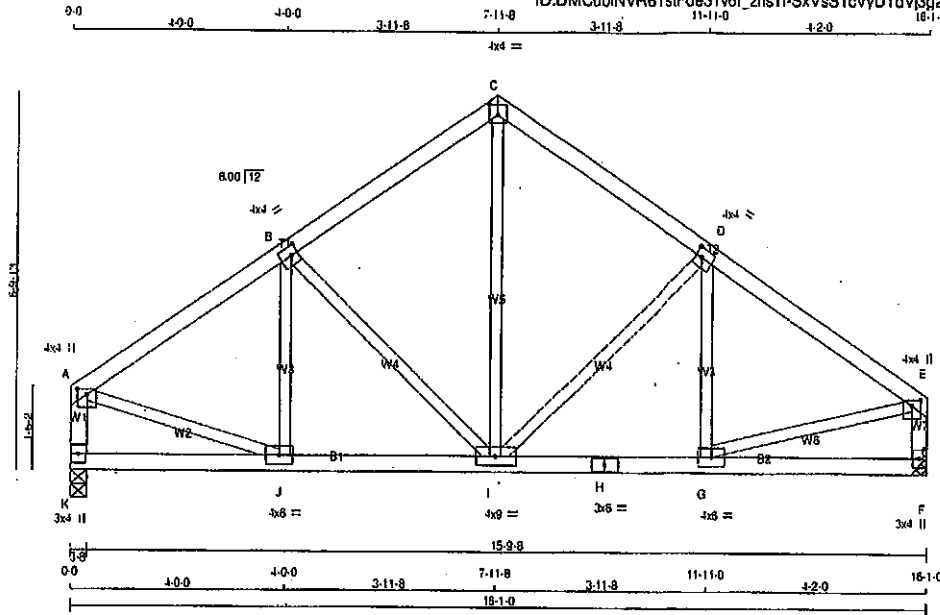

Scale = 1/32

LUMBER					
N. L. G. A. RULES					
CHORDS	SIZE	LUMBER		DESCR	
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
K - A	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
K - H	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TMWW-i	MT20	4.0	4.0	2.00	1.50
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TMWW-i	MT20	4.0	4.0	2.00	1.50
E	TMVW+p	MT20	4.0	4.0	1.25	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMWW-i	MT20	4.0	6.0		
H	BS-i	MT20	3.0	6.0		
I	BMWW-i	MT20	4.0	9.0		
J	BMWW-i	MT20	4.0	6.0		
K	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
K	887	0	887	0
F	887	0	887	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3'-8".

UNFACTORED REACTIONS							
	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	627	411 0	0 0	0 0	0 0	216 0	0 0
F	627	411 0	0 0	0 0	0 0	216 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CS1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)
FR-TO		FROM TO			FR-TO		
A-B	-888 0	-91.8	-91.8 0.19 (1)	6.25	J-B	-142 18	0.04 (1)
B-C	-887 0	-91.8	-91.8 0.18 (1)	6.25	B-I	-263 0	0.13 (1)
C-D	-688 0	-91.8	-91.8 0.19 (1)	6.25	I-C	0 461	0.10 (1)
D-E	-891 0	-91.8	-91.8 0.20 (1)	6.25	I-D	-292 0	0.15 (1)
K-A	-855 0	0.0	0.0 0.09 (1)	7.81	G-D	-117 28	0.03 (1)
F-E	-853 0	0.0	0.0 0.09 (1)	7.81	A-J	0 772	0.17 (1)
					G-E	0 787	0.18 (1)
K-J	0 0	-18.5	-18.5 0.07 (4)	10.00			
J-I	0 740	-18.5	-18.5 0.15 (1)	10.00			
I-H	0 761	-18.5	-18.5 0.15 (1)	10.00			
H-G	0 761	-18.5	-18.5 0.15 (1)	10.00			
G-F	0 0	-18.5	-18.5 0.07 (4)	10.00			

TOTAL WEIGHT = 2 X 69 = 137 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.20/1.00 (D-E:1), BC=0.15/1.00 (G-I:1), WB=0.10/1.00 (E-G:1), SS=0.15/1.00 (D-E:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (E) (INPUT = 0.90)
JSI METAL= 0.25 (H) (INPUT = 1.00)




Structural component only
DWG# T-2007631

JOB NAME 408222	TRUSS NAME T11S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:13 2020 Page 1

ID:DMCubINVR6TsFoe31v6I zns1l-YVCj26HKS3BnFRQzo81qj7reK5PdcqyG49siazMFIV

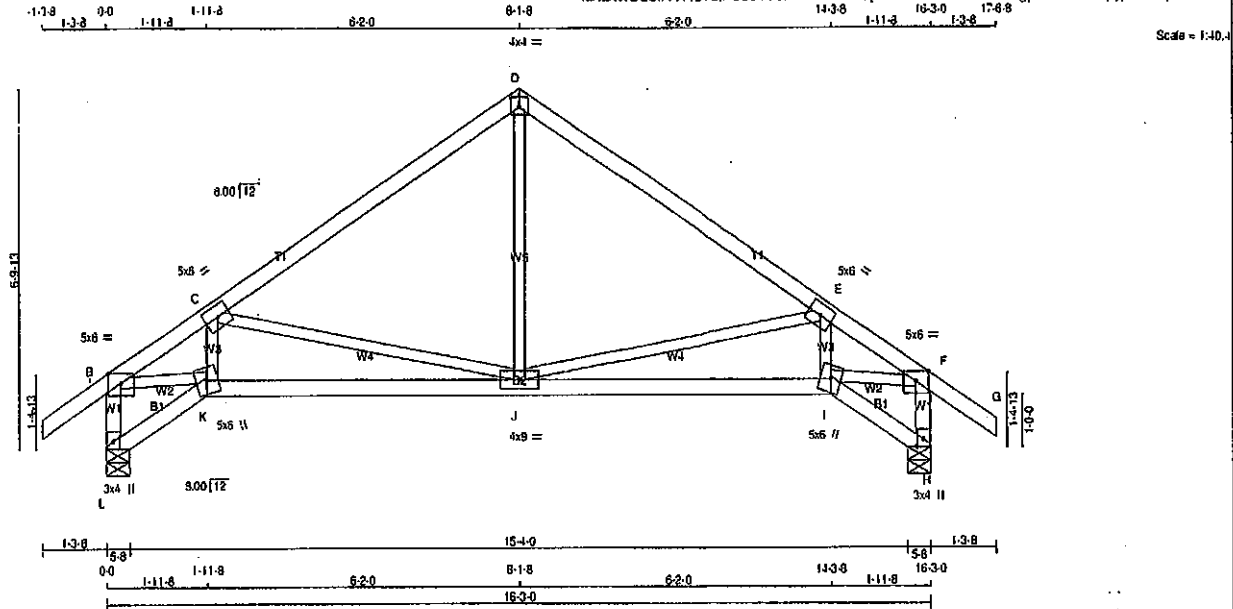

TOTAL WEIGHT = 2 X 67 = 134 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
L - B	2x4	DRY	No.2
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	6.0	Edge
C	TMWW-l	MT20	5.0	6.0	
D	TTW-p	MT20	4.0	4.0	2.25 2.00
E	TMWW-l	MT20	5.0	6.0	
F	TMVW-p	MT20	5.0	6.0	Edge
H	BMV1+p	MT20	3.0	4.0	Edge
I	BBWW+m	MT20	5.0	6.0	
J	BMWW-l	MT20	4.0	9.0	
K	BBWW+m	MT20	5.0	6.0	
L	BMV1+p	MT20	3.0	4.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	GROSS REACTION	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
L	1022	0	1022	0	0	5-8	5-8		
H	1022	0	1022	0	0	5-8	5-8		

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	LIVE	PERM. LIVE	WIND	DEAD	SOL.
L	COMBINED	SNOW	0	0	0	234	0
H	COMBINED	SNOW	0	0	0	234	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS I, L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)
FR-TO		FROM TO		LENGTH	FR-TO		
L-B	-1004 0	0.0	0.0	0.11 (1)	7.80	B-K	0 1321 0.30 (1)
A-B	0 35	-91.8	-91.8	0.12 (1)	10.00	K-C	0 55 0.02 (4)
B-C	-1508 0	-91.8	-91.8	0.33 (1)	4.97	C-J	-869 0 0.46 (1)
C-D	-841 0	-91.8	-91.8	0.41 (1)	8.03	J-D	0 444 0.10 (1)
D-E	-841 0	-91.8	-91.8	0.42 (1)	8.07	J-E	-861 0 0.47 (1)
E-F	-1510 0	-91.8	-91.8	0.33 (1)	4.97	I-E	0 56 0.02 (4)
F-G	0 35	-91.8	-91.8	0.12 (1)	10.00	I-F	0 1323 0.30 (1)
H-F	-1004 0	0.0	0.0	0.11 (1)	7.80		
L-K	0 0	-18.5	-18.5	0.02 (4)	10.00		
K-J	0 1319	-18.5	-18.5	0.33 (1)	10.00		
J-I	0 1320	-18.5	-18.5	0.33 (1)	10.00		
I-H	0 0	-18.5	-18.5	0.02 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CSI: TC=0.42; 1.00 (D-E:1), BC=0.33; 1.00 (J-I:1), WB=0.47; 1.00 (E-J:1), SS=0.21; 1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1887
	788	1887	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (I) (INPUT = 0.90)
JSI METAL = 0.47 (K) (INPUT = 1.00)




Structural component only
DWG# T-2007614

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T12S	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:14 2020 Page 1

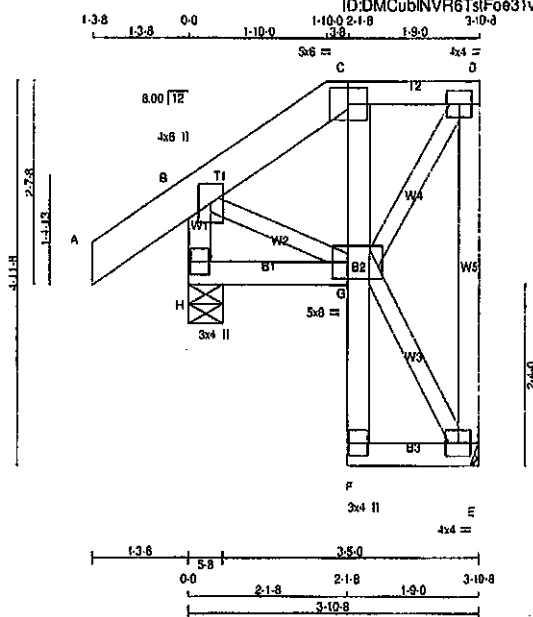

Scale = 1:27.5

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS	2x6	DRY	No.2
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
H - B	2x4	DRY	No.2
H - G	2x4	DRY	No.2
F - C	2x4	DRY	No.2
F - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)			
JT	TYPE	PLATES	W L E N Y X
B	TMVW+p	MT20	4.0 6.0
C	TTV-m	MT20	5.0 6.0
D	TMVW-i	MT20	4.0 4.0
E	BMVW-i	MT20	4.0 4.0
F	BMV+p	MT20	3.0 4.0
G	BMVWW-i	MT20	5.0 6.0 2.50 2.50
H	BMV-i+p	MT20	3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	IN-SX	IN-SX	MECHANICAL
E	214	0	0	0	5-8	5-8	
H	344	0	0	0	5-8	5-8	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS							
JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	151	99	0	0	0	0	0
H	241	172	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING							
TOTAL LOAD CASES: (5)							
CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 36	-91.8 -91.8	0.07 (5)	10.00	G-D	0 139	0.03 (1)
B-C	-105 0	-91.8 -91.8	0.03 (1)	6.25	B-G	0 98	0.02 (1)
C-D	-79 0	-91.8 -91.8	0.05 (1)	8.25	G-E	-3 0	0.00 (1)
E-D	-196 0	0.0 0.0	0.08 (1)	7.81			
H-B	-323 0	0.0 0.0	0.03 (1)	7.81			
H-G	0 0	-18.5 -18.5	0.03 (4)	10.00			
F-G	0 17	0.0 0.0	0.01 (1)	10.00			
G-C	-119 0	0.0 0.0	0.01 (1)	7.81			
F-E	0 2	-18.5 -18.5	0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.08/1.00 (D-E:1), BC=0.03/1.00 (G-H:4), WB=0.03/1.00 (D-G:1), SS=0.07/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 (S BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 788	1987 1556

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (B) (INPUT = 0.90)
JSI METAL = 0.11 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007615

DRY-SEASONED LUMBER	BEARING MATERIAL TO BE SPEC NO 3 OR BETTER AT JOINTS & S K	SPACING = 24.0 IN. C/C
---------------------	--	------------------------

DESIGN CONSISTS OF 2 TRUSSES BUILT BRACING

FOLLOWS:	MAX. OVERLAP BOTTOM CHORD LENGTH = 75.00 FT. ON EACH SIDE OF CHORD SET AS FOLLOWS:	OF 0.00/12
----------	--	------------

FOR CHORDS: (3.125"x2") SPIRAL NAILS

C.F.	2	12	SIDE(183.11	CHORDS	WELLS	THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR CIVIL APPLICATIONS ONLY. IT IS NOT TO BE USED FOR INDUSTRIAL OR AGRICULTURAL PURPOSES.
------	---	----	-------------	--------	-------	--

MEMB.	FORCE	VERT. LOAD	LC1	MAX	MAX.	MEMB.	FORCE	MAX
TOP								

BOTTOM CHORDS : 10.122'X3" SPIRAL NAILS		FR-10		FROM TO		LENGTH FR-10		R-G	
S-B	2	12	SIDE 183.11	A-B	0.33	-91.8	-91.8	0.04 (1)	10.00
								-431	9
								0.05 (1)	

N-K	2	12	SIDE10.01	C-T	-7102 0	-91.8	-91.8	0.31 (1)	4.28	Q-D	-1555 0	0.19 (1)	-TPIC 2011, TPIC 2014
USDC	2	12	NAK 2	C-T	7102 0	91.8	91.8	0.31 (1)	4.28	Q-D	1555 0	0.19 (1)	
USDC	2	12	NAK 2	C-T	7102 0	91.8	91.8	0.31 (1)	4.28	Q-D	1555 0	0.19 (1)	

V-D	-7102 0	-91.8	-91.8	0.31 (1)	4.28	O-G	0 1085	0.13 (1)	LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF
-----	---------	-------	-------	----------	------	-----	--------	----------	---

GIRDER NAILING ASSUMES NAILED HANGERS ARE	W-X	-8810	0	-91.8	-91.8	0.32 (1)	4.05	L-H	0	3312	0.34 (1)	ALLOWABLE DEF. (LL) = L/360 (1.17")
	X-Y	-8010	0	-91.8	-91.8	0.32 (1)	4.05	L-H	-421	10	0.05 (1)	

E-F	-8010	0	-91.8	-91.8	0.33 (1)	4.03	L-1	0 - 4022	0.50 (1)	ALLOWED DEFLECT (TL) = 1.380 (1.17")
E-Z	-8010	0	-91.8	-91.8	0.33 (1)	4.03				CALCULATED VERT. DEFLECT (TL) = 1.999 (0.37")

LOAD TO BE TRANSFERRED TO EACH PLY.	AA-AB	-8010	0	-91.8	-91.8	0.33 (1)	4.03	CSI: TC=0.33/1.00 [E-G:1] , BC=0.52/1.00 [O-Q:1] ,
				0.0	0.0	0.00 (1)	1.00	

AC-AD	-7070	0	-91.8	-91.8	0.30 (1)	4.27	DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
-------	-------	---	-------	-------	----------	------	--

AE-H	-7070	0	-91.8	-91.8	0.30 (1)	4.27
H-I	-4808	0	-91.8	-91.8	0.13 (1)	5.26

COMPANION LIVE LOAD FACTOR = 1.00

S-B	-3367	0	0.0	0.0	0.12 (1)	7.58	AUTOSOLVE HEELS OFF
S-L	3368	0	0.0	0.0	0.12 (1)	7.58	

S-AF	0 0	-18.5	-18.5	0.06 (4)	10.00	RESPONSIBLE FOR QUALITY CONTROL IN THE
------	-----	-------	-------	----------	-------	--

RAH	0	4024	-18.3	-18.3	0.31 (1)	10.00
NAIL VALUES						

	(PSI)	(PLI)	(PLI)
MAX. ADB	MAX. FUEL	MAX. FUEL	MAX. FUEL

P-AK	0	7102	-18.5	-18.5	0.52 (1)	10.00
------	---	------	-------	-------	----------	-------


AL-O	0 7102	-10.0	-10.0	-0.02 (1)	10.00
O-AM	0 7070	-18.5	-18.5	-0.52 (1)	10.00

PLATE ROTATION TOL. = 5.0 Deg.

N-AN	0	7070	-18.5	-18.5	0.52 (1)	10.00	JSI GRIP = 0.89 (Q) INPUT = 0.90
ANL AA	0	7070	-18.5	-18.5	0.52 (1)	10.00	ISI METAL = 0.68 (Q) INPUT = 1.00

Structural component only	AO-AP	0 3960	-18.5	-18.5	0.30 (1)	10.00
---------------------------	-------	--------	-------	-------	----------	-------

DWG# 1-2007652	AS-E	Q 5000	TED TED TSDT97 TSDS		CONTINUED ON PAGE 2
----------------	------	--------	---------------------	--	---------------------



DWG# T-2007632 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T20	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:02 2020 Page 2	
				ID:DMCubINVR6TslFog31v6I zns1l-x73EgNd7XbU6sasc0DbPaw0PaBNFZ7YIIB c8zMEMh	

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0	6.0 1.75 2.75
C	TTWW-m	MT20	6.0	9.0 2.75 3.50
D	TMVW-l	MT20	5.0	8.0
E	TMVW-w	MT20	3.0	6.0
F	TS-l	MT20	5.0	6.0
G	TMVW-l	MT20	5.0	6.0
H	TTWW-m	MT20	6.0	9.0 2.75 3.50
I	TMVW-p	MT20	5.0	6.0 1.75 2.75
K	BMVl-p	MT20	3.0	6.0
L	BMVW-l	MT20	5.0	6.0 2.50 2.75
M	BMVW-l	MT20	5.0	6.0
N	BS-l	MT20	5.0	6.0
O	BMVW-l	MT20	5.0	6.0
P	BS-l	MT20	5.0	6.0
Q	BMVW-l	MT20	5.0	6.0
R	BMVW-l	MT20	5.0	6.0 2.50 2.75
S	BMVl-p	MT20	3.0	6.0

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	FACTORED VERT. LOAD (LBS)	MAX. UNBRAC. LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	FACTORED VERT. LOAD (LBS)	MAX. UNBRAC. LENGTH (FT)
FR-TO					FR-TO				
L-AR	0 0		-18.5	-18.5 0.08 (4)	10.00				
AR-AS	0 0		-18.5	-18.5 0.08 (4)	10.00				
AS-K	0 0		-18.5	-18.5 0.08 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-10-0	-80	-87	---	FRONT	VERT	DEAD	---	C1
C	4-10-0	-311	-311	---	FRONT	VERT	SNOW	---	C1
D	11-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	30-4-0	-80	-87	---	FRONT	VERT	DEAD	---	C1
H	30-4-0	-311	-311	---	FRONT	VERT	SNOW	---	C1
N	21-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Q	11-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
R	5-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	5-2-12	-138	-138	---	FRONT	VERT	TOTAL	---	C1
U	7-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	9-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	13-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	15-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	17-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	19-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	29-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	1-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	3-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	7-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	9-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	13-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	15-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AL	17-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AM	19-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AN	23-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	25-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AP	27-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AQ	29-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AR	31-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AS	33-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007632

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T21	1	1	GREEN PARK HOMES	
TAMRACK ROOT TRUSS, BURLINGTON		TRUSS DESC.		Version 8.310 5 Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:04:03 2020 Page 1	

ID:DMCubINVR6TslF0e31v6l zns1l-PKdclleUqJLk0D3AWIqxoTBJ Wk xSi yxX9bzMEMg

1-3.8 0-0 3-4.9 3-4.9 3-2.1 6-6.9 5-8.13 12-1.7 5-5.9 17-7.0 5-5.9 23-0.9 5-8.13 28-7.7 31-9.7 35-2.0 38-5.8 1-3.8

Scale = 1:57.6

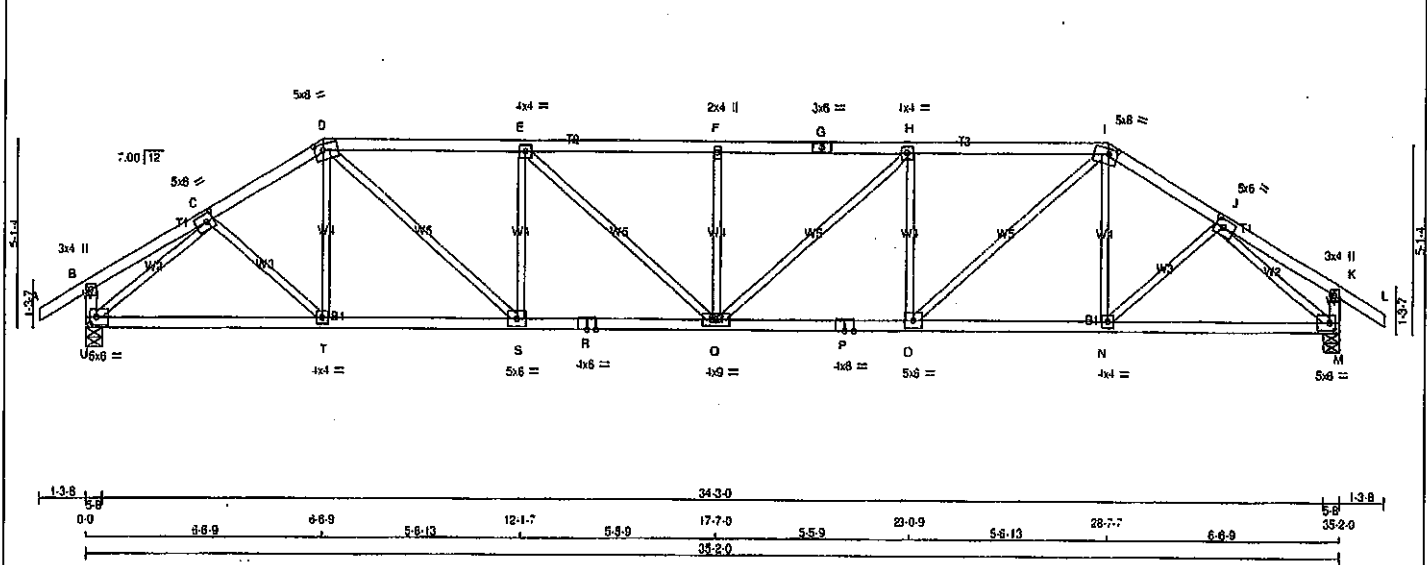

TOTAL WEIGHT = 142 LB (M)

N. L. G. A. RULES				BUILDING DESIGNER								DESIGN CRITERIA							
CHORDS SIZE				LUMBER				DESCR.				BEARINGS				SPECIFIED LOADS:			
A - D	2x4	DRY	No.2	SPF	FACTORED		MAXIMUM FACTORED		INPUT		REQD		TOP CH. LL = 25.8 PSF						
D - G	2x4	DRY	No.2	SPF	GROSS REACTION		GROSS REACTION		BRG		BRG		DL = 6.0 PSF						
G - I	2x4	DRY	No.2	SPF	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BOT CH. LL = 0.0 PSF						
I - L	2x4	DRY	No.2	SPF	U	2084	0	2084	0	0	5-8	5-8	DL = 7.4 PSF						
U - B	2x4	DRY	No.2	SPF	M	2084	0	2084	0	0	5-8	5-8	TOTAL LOAD = 39.0 PSF						
M - K	2x4	DRY	No.2	SPF	UNFACTORED REACTIONS								SPACING = 24.0 IN. O.C.						
U - R	2x4	DRY	No.2	SPF															
R - P	2x4	DRY	No.2	SPF	1ST CASE								MAX. MIN. COMPONENT REACTIONS						
P - M	2x4	DRY	No.2	SPF	JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	LOADING IN FLAT SECTION BASED ON A SLOPE						
ALL WEBS	2x3	DRY	No.2	SPF	U	1457	970	0	0	0	488	0					0		

DRY: SEASONED LUMBER.

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.12 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	MAX	MEMB.	MAX. FACTORED	FACTORED	MAX
FR-TO	FORCE (LBS)	VERT. LOAD (PLF)	CSI (LC)	FR-TO	FORCE (LBS)	VERT. LOAD (PLF)	CSI (LC)
A-B	0 32	-91.8	-91.8 0.12 (1)	10.00	C-T	0 213	0.05 (1)
B-C	0 13	-91.8	-91.8 0.12 (1)	10.00	T-D	-8 69	0.02 (1)
C-D	-2527 0	-91.8	-91.8 0.20 (1)	4.18	D-S	0 1447	0.33 (1)
D-E	-3284 0	-91.8	-91.8 0.68 (1)	3.30	S-E	-853 0	0.33 (1)
E-F	-3585 0	-91.8	-91.8 0.70 (1)	3.12	E-Q	0 428	0.10 (1)
F-G	-3585 0	-91.8	-91.8 0.70 (1)	3.12	Q-F	-482 0	0.18 (1)
G-H	-3585 0	-91.8	-91.8 0.70 (1)	3.12	Q-H	0 428	0.10 (1)
H-I	-3284 0	-91.8	-91.8 0.68 (1)	3.30	O-H	-853 0	0.33 (1)
I-J	-2527 0	-91.8	-91.8 0.20 (1)	4.18	O-I	0 1447	0.33 (1)
J-K	0 13	-91.8	-91.8 0.12 (1)	10.00	N-I	-8 69	0.02 (1)
K-L	0 32	-91.8	-91.8 0.12 (1)	10.00	N-J	0 213	0.05 (1)
U-B	-249 0	0.0	0.0 0.03 (1)	7.81	U-C	-2671 0	0.82 (1)
M-K	-249 0	0.0	0.0 0.03 (1)	7.81	J-M	-2671 0	0.82 (1)
U-T	0 2005	-18.5	-18.5 0.42 (1)	10.00			
T-S	0 2167	-18.5	-18.5 0.44 (1)	10.00			
S-R	0 3264	-18.5	-18.5 0.58 (1)	10.00			
R-Q	0 3264	-18.5	-18.5 0.58 (1)	10.00			
Q-P	0 3264	-18.5	-18.5 0.58 (1)	10.00			
P-O	0 3264	-18.5	-18.5 0.58 (1)	10.00			
O-N	0 2167	-18.5	-18.5 0.44 (1)	10.00			
N-M	0 2005	-18.5	-18.5 0.42 (1)	10.00			

ALLOWABLE DEF. (LL) = L/360 (1.17")
CALCULATED VERT. DEF. (LL) = L/999 (0.21")
ALLOWABLE DEF. (TL) = L/360 (1.17")
CALCULATED VERT. DEF. (TL) = L/999 (0.39")

CS: TC=0.70/1.00 (E-F:1), BC=0.58/1.00 (Q-S:1),
WB=0.82/1.00 (J-M:1), SS=0.24/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 788 1987 1855

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (M) (INPUT = 0.90)
JSI METAL = 0.74 (R) (INPUT = 1.00)




Structural component only
DWG# T-2007633

JOB NAME 408223	TRUSS NAME T22	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:04 2020 Page 1
ID:DMCubiNVR6TstFoe31v8l zns11-WB743eNF8rCMAoFJGG3U79GFOtjTrCcg4htzMEM
20-7-14 4-3-0 26-10-14 4-0-5 30-11-3 4-2-13 35-2-0 36-5-8 1-3-8
Scale = 1:57.6

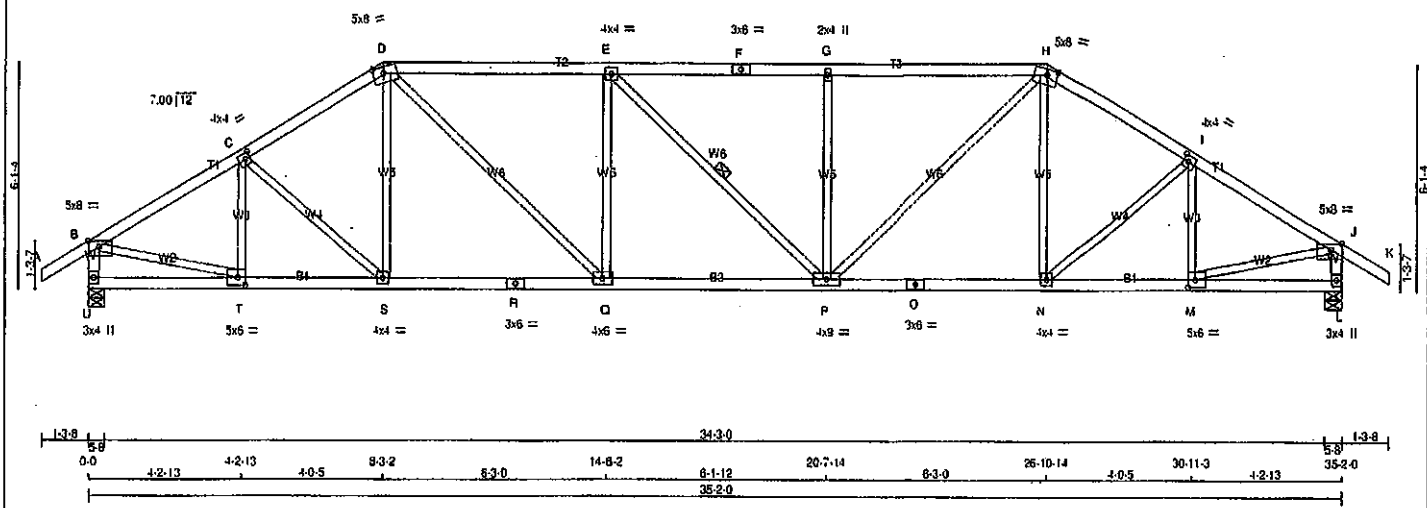

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - H	2x4	DRY No.2	SPF
H - K	2x4	DRY No.2	SPF
U - B	2x4	DRY No.2	SPF
L - J	2x4	DRY No.2	SPF
U - R	2x4	DRY No.2	SPF
R - O	2x4	DRY No.2	SPF
O - L	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	8.0	Edge 3.50
C	TMWW-I	MT20	4.0	4.0	2.00 1.75
D	TTWW-m	MT20	5.0	8.0	2.00 3.50
E	TMWW-I	MT20	4.0	4.0	
F	TS-I	MT20	3.0	6.0	
G	TMW-w	MT20	2.0	4.0	
H	TTWW-m	MT20	5.0	8.0	2.00 3.50
I	TMWW-I	MT20	4.0	4.0	2.00 1.75
J	TMVW-p	MT20	5.0	8.0	Edge 3.50
L	BMV-I-p	MT20	3.0	4.0	
M	BMWW-I	MT20	5.0	8.0	2.50 2.50
N	BMWW-I	MT20	4.0	4.0	
O	BS-I	MT20	3.0	6.0	
P	BMWW-I	MT20	4.0	9.0	
Q	BMWW-I	MT20	4.0	6.0	
R	BS-I	MT20	3.0	6.0	
S	BMWW-I	MT20	4.0	4.0	
T	BMWW-I	MT20	5.0	6.0	2.50 2.50
U	BMV-I-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED				MAXIMUM FACTORED			
GROSS REACTION				GROSS REACTION			
JT	VERT	HORZ		DOWN	HORZ	UPLIFT	IN-SX
U	2064	0		2064	0	0	5-8
L	2064	0		2064	0	0	5-8

UNFACTORED REACTIONS							
1ST LOASE				MAX. MIN. COMPONENT REACTIONS			
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
U	1457	970	0	0	0	0	488
L	1457	970	0	0	0	0	488

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS U, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.37 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1:2 LENGTH OF E-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
A-B	0 32	-91.8 -91.8 0.12 (1)	10.00	T-C	-428 0	0.10 (1)	
B-C	-2468 0	-91.8 -91.8 0.35 (1)	4.07	C-S	-39 0	0.02 (1)	
C-D	-2478 0	-91.8 -91.8 0.34 (1)	4.08	S-D	0 131	0.04 (4)	
D-E	-2910 0	-91.8 -91.8 0.75 (1)	3.37	D-Q	0 1076	0.24 (1)	
E-F	-2909 0	-91.8 -91.8 0.74 (1)	3.38	Q-E	-617 0	0.38 (1)	
F-G	-2909 0	-91.8 -91.8 0.74 (1)	3.38	E-P	-2 0	0.00 (1)	
G-H	-2909 0	-91.8 -91.8 0.75 (1)	3.38	P-G	-617 0	0.38 (1)	
H-I	-2478 0	-91.8 -91.8 0.34 (1)	4.08	P-H	0 1073	0.24 (1)	
I-J	-2468 0	-91.8 -91.8 0.35 (1)	4.07	N-H	0 132	0.04 (4)	
J-K	0 32	-91.8 -91.8 0.12 (1)	10.00	N-I	-39 0	0.02 (1)	
U-B	-2025 0	0.0 0.0 0.21 (1)	5.94	M-I	-426 0	0.10 (1)	
L-J	-2025 0	0.0 0.0 0.21 (1)	5.94	B-T	0 2205	0.50 (1)	
				M-J	0 2205	0.50 (1)	
U-T	0 0	-18.5 -18.5 0.07 (4)	10.00				
T-S	0 2149	-18.5 -18.5 0.41 (1)	10.00				
S-R	0 2122	-18.5 -18.5 0.41 (1)	10.00				
R-Q	0 2122	-18.5 -18.5 0.41 (1)	10.00				
Q-P	0 2910	-18.5 -18.5 0.54 (1)	10.00				
P-O	0 2122	-18.5 -18.5 0.41 (1)	10.00				
O-N	0 2122	-18.5 -18.5 0.41 (1)	10.00				
N-M	0 2149	-18.5 -18.5 0.41 (1)	10.00				
M-L	0 0	-18.5 -18.5 0.07 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.16")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CSI: TC=0.75:1.00 (D-E:1), 80=0.54:1.00 (P-Q:1), WB=0.50:1.00 (B-T:1), SS=0.27:1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRP= 0.89 (T) INPUT = 0.90
JSI METAL = 0.79 (O) INPUT = 1.00




Structural component only
DWG# T-2007634

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T23	1	1	GREEN PARK HOMES	
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:06 2020 Page 1
ID:DMCubINVR6TstFos31v6l zns11-pvJIVkgeml5wbUyeratXZQ5aqCaVBjG8gw9BlvzMEMd

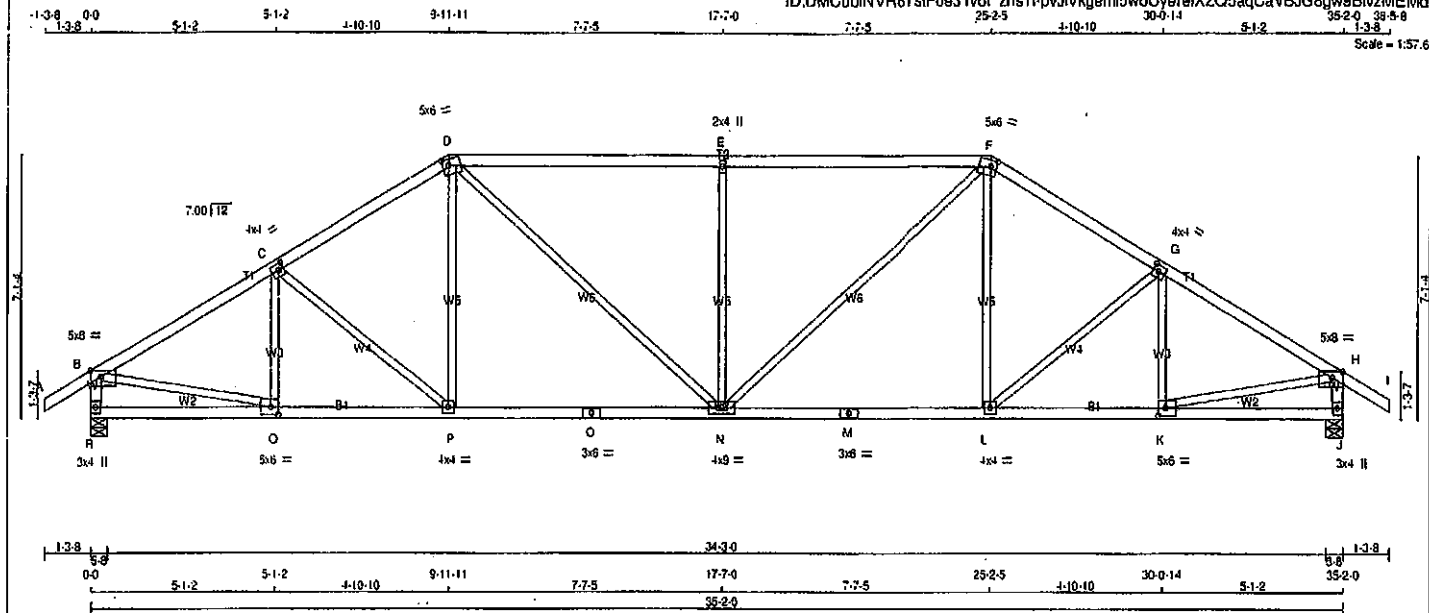

TOTAL WEIGHT = 145 lb (M/F)

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - B	2x4	DRY	No.2
B - H	2x4	DRY	No.2
H - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TMVW-l	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	8.0	2.00	2.00
E	TMVW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	8.0	2.00	2.00
G	TMVW-l	MT20	4.0	4.0	2.00	1.75
H	TMVW-p	MT20	5.0	8.0	Edge	3.50
J	BMV-l-p	MT20	3.0	4.0		
K	BMVW-l	MT20	5.0	6.0	2.50	2.50
L	BMVW-l	MT20	4.0	4.0		
M	BS-l	MT20	3.0	6.0		
N	BMVW-w-l	MT20	4.0	9.0		
O	BS-l	MT20	3.0	6.0		
P	BMVW-l	MT20	4.0	4.0		
Q	BMVW-l	MT20	5.0	6.0	2.50	2.50
R	BMV-l-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
R	2084	0	2084	0
J	2084	0	2084	0

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS								
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
R	1457	970.0	0.0	0.0	0.0	488.0	0.0		
J	1457	970.0	0.0	0.0	0.0	488.0	0.0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.18 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 32	-91.8 -91.8 0.12 (1)	10.00	Q-C	-335 0	0.09 (1)	
B-C	-2537 0	-91.8 -91.8 0.39 (1)	4.00	C-P	-216 0	0.16 (1)	
C-D	-2388 0	-91.8 -91.8 0.37 (1)	4.11	P-D	0 258	0.06 (4)	
D-E	-2609 0	-91.8 -91.8 0.88 (1)	3.18	D-N	0 752	0.17 (1)	
E-F	-2609 0	-91.8 -91.8 0.88 (1)	3.18	N-E	-860 0	0.75 (1)	
F-G	-2388 0	-91.8 -91.8 0.37 (1)	4.11	N-F	0 752	0.17 (1)	
G-H	-2537 0	-91.8 -91.8 0.39 (1)	4.00	L-F	0 258	0.06 (4)	
H-I	0 32	-91.8 -91.8 0.12 (1)	10.00	L-G	-216 0	0.16 (1)	
R-B	-2020 0	0.0 0.0 0.21 (1)	5.94	K-G	-335 0	0.09 (1)	
J-H	-2020 0	0.0 0.0 0.21 (1)	5.94	B-Q	0 2253	0.51 (1)	
				K-H	0 2253	0.51 (1)	
R-Q	0 0	-18.5 -18.5 0.10 (4)	10.00				
Q-P	0 2213	-18.5 -18.5 0.45 (1)	10.00				
P-O	0 2048	-18.5 -18.5 0.44 (1)	10.00				
O-N	0 2048	-18.5 -18.5 0.44 (1)	10.00				
N-M	0 2048	-18.5 -18.5 0.44 (1)	10.00				
M-L	0 2048	-18.5 -18.5 0.44 (1)	10.00				
L-K	0 2213	-18.5 -18.5 0.45 (1)	10.00				
K-J	0 0	-18.5 -18.5 0.10 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIG 2011, TPIG 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.13")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.27")

CSI: TC=0.88/1.00 (E/F:1), BC=0.45/1.00 (K/L:1), WB=0.75/1.00 (E/N:1), SS=0.34/1.00 (E/F:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (K) (INPUT = 0.90)
JSI METAL = 0.72 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007635

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T24	1	1	GREEN PARK HOMES	


Tamrack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:07 2020 Page 1

ID:DMCubINVR6TslFoe31v6l_zns1l-H5s74hGX3DnDeWqPLpm6aepobw_wk9HuavklMzMEMc

1-3-8 0-0 5-11-8 5-11-8 5-8-14 11-8-5 5-10-11 17-7-0 5-10-11 5-8-14 29-2-10 5-11-8 35-2-0 35-5-8

Scale = 1:57.6

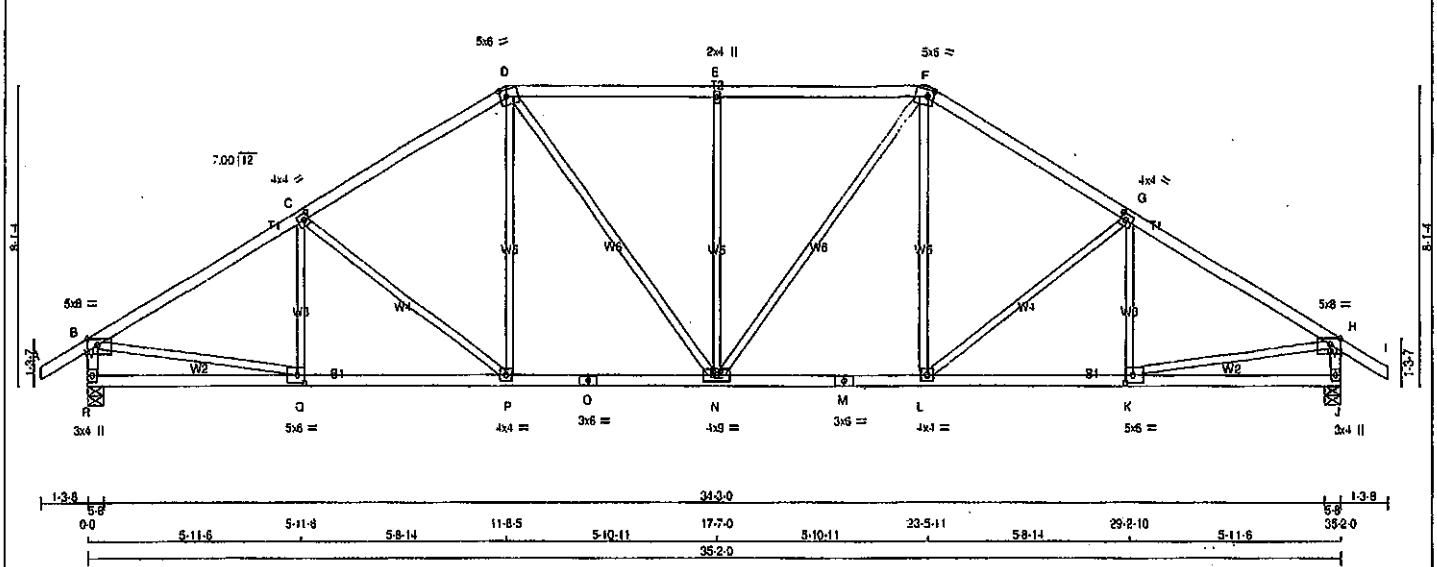

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT

DRY: SEASONED LUMBER.

TOTAL WEIGHT = 151 lb (M/F)

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D	SPECIFIED LOADS:	
A - D	2x4	DRY	No.2	SPF	FACTORED	GROSS REACTION	GROSS REACTION	8RG	8RG	TOP CH. LL = 25.6 PSF	
D - F	2x4	DRY	No.2	SPF	VERT	DOWN	DOWN	UPLIFT	IN-SX	DL = 8.0 PSF	
F - I	2x4	DRY	No.2	SPF	R	2084 0	2084 0	0	5-8	BOT CH. LL = 0.0 PSF	
R - B	2x4	DRY	No.2	SPF	J	2084 0	2084 0	0	5-8	DL = 7.4 PSF	
J - H	2x4	DRY	No.2	SPF						TOTAL LOAD = 39.0 PSF	
R - O	2x4	DRY	No.2	SPF							
O - M	2x4	DRY	No.2	SPF							
M - J	2x4	DRY	No.2	SPF							

ALL WEBS EXCEPT	2x3	DRY	No. 2	SPF	1ST LCASE								MAX. MIN. COMPONENT REACTIONS								LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																														
					COMBINED				SNOW				LIVE				PERM. LIVE					WIND				DEAD				SOIL																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																					
					JT																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																														

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.81 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	MAX. FACTORED	MEMB.	MAX. FACTORED	FACTORED	MAX. FACTORED
FR-TO	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	FR-TO	FORCE (LBS)	MAX. CSI (LC)	MAX. CSI (LC)
A-B	0 32	-91.8 -91.8 0.12 (1)	10.00	Q-C	-252 12	0.08 (1)	0.08 (1)
B-C	-2575 0	-91.8 -91.8 0.54 (1)	3.81	C-P	-388 0	0.41 (1)	0.41 (1)
C-D	-2283 0	-91.8 -91.8 0.50 (1)	4.05	P-D	0 345	0.08 (1)	0.08 (1)
D-E	-2236 0	-91.8 -91.8 0.49 (1)	4.08	D-N	0 480	0.11 (1)	0.11 (1)
E-F	-2236 0	-91.8 -91.8 0.49 (1)	4.08	N-E	-662 0	0.84 (1)	0.84 (1)
F-G	-2283 0	-91.8 -91.8 0.50 (1)	4.05	N-F	0 480	0.11 (1)	0.11 (1)
G-H	-2575 0	-91.8 -91.8 0.54 (1)	3.81	L-F	0 345	0.08 (1)	0.08 (1)
H-I	0 32	-91.8 -91.8 0.12 (1)	10.00	L-G	-388 0	0.41 (1)	0.41 (1)
R-B	-2016 0	0.0 0.0 0.21 (1)	5.94	K-G	-252 12	0.08 (1)	0.08 (1)
J-H	-2016 0	0.0 0.0 0.21 (1)	5.94	B-O	0 2281	0.51 (1)	0.51 (1)
				K-H	0 2281	0.51 (1)	0.51 (1)
R-Q	0 0	-18.5 -18.5 0.14 (4)	10.00				
Q-P	0 2251	-18.5 -18.5 0.43 (1)	10.00				
P-O	0 1947	-18.5 -18.5 0.38 (1)	10.00				
O-N	0 1947	-18.5 -18.5 0.38 (1)	10.00				
N-M	0 1947	-18.5 -18.5 0.38 (1)	10.00				
M-L	0 1947	-18.5 -18.5 0.38 (1)	10.00				
L-K	0 2251	-18.5 -18.5 0.43 (1)	10.00				
K-J	0 0	-18.5 -18.5 0.14 (4)	10.00				

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

ALLOWABLE DEFL. (LL) = L/360 (1.17")

CALCULATED VERT. DEFL. (LL) = L/999 (0.12")

ALLOWABLE DEFL. (TL) = L/360 (1.17")

CALCULATED VERT. DEFL. (TL) = L/999 (0.22")

CSI: TC=0.54/1.00 (B-C:1), BC=0.43/1.00 (P-Q:1), WB=0.84/1.00 (E-N:1), SS=0.26/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 L/S BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (Q) (INPUT = 0.90)

JSI METAL= 0.61 (M) (INPUT = 1.00)

LICENSED PROFESSIONAL ENGINEER

H. J. G. ALVES

100009024

PROVINCE OF ONTARIO

Structural component only

DWG# T-2007636



JSI GRIP = 0.85 (S) (INPUT = 0.90)
JSI METAL = 0.88 (IN) (INPUT = 1.00)


Structural component only
DWG# T-2007637

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T25A	3	1	GREEN PARK HOMES	
Tamborack Roof Truss, Burlington				TRUSS DESC.	

Tamborack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:09 2020 Page 1

ID:DMCubINVR6Tsf0e31v6I zns11-DU u8miW3gUUSxgCWmsEB3j6IPbBOjwaMOrMeZMEMa

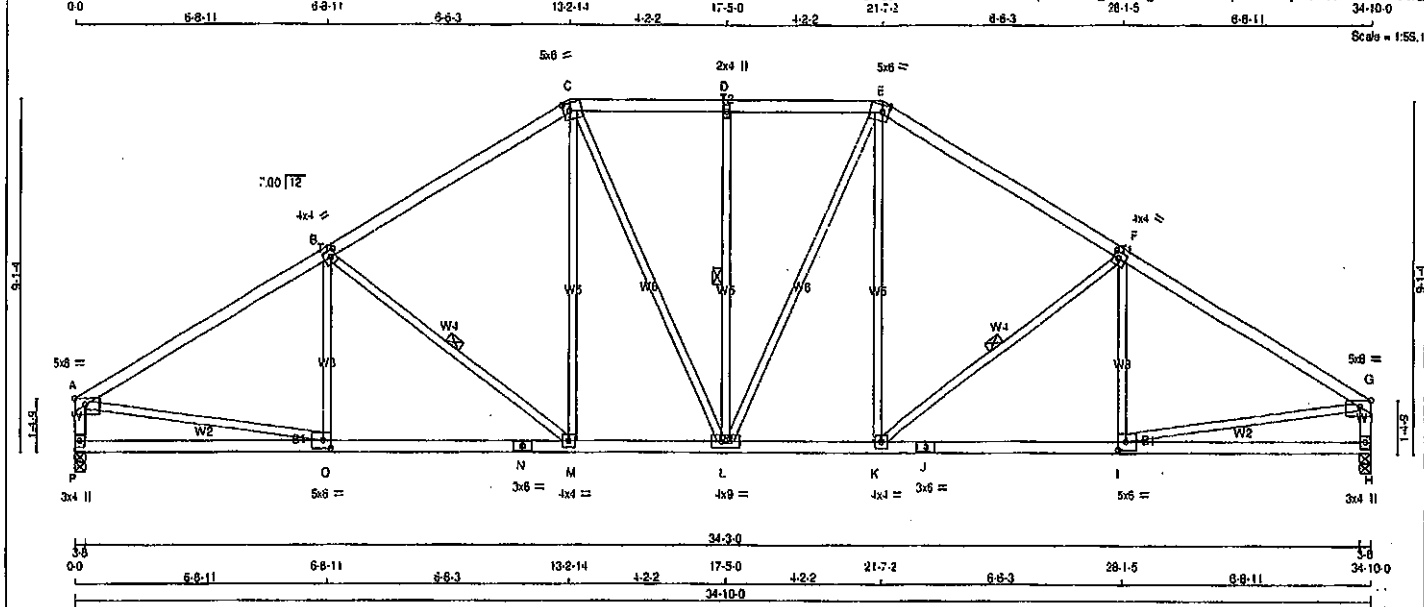

TOTAL WEIGHT = 3 X 154 = 462 lb (M/F)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - E	2x4	DRY	No.2	SPF		
E - G	2x4	DRY	No.2	SPF		
P - A	2x4	DRY	No.2	SPF		
H - G	2x4	DRY	No.2	SPF		
P - N	2x4	DRY	No.2	SPF		
N - J	2x4	DRY	No.2	SPF		
J - H	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						

DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE				
A - TMVW-p	MT20	5.0	8.0	2.00 Edge
B - TMVW-i	MT20	4.0	4.0	2.00 1.75
C - TTWW-m	MT20	5.0	6.0	2.25 2.00
D - TMVW-w	MT20	2.0	4.0	
E - TTWW-m	MT20	5.0	6.0	2.25 2.00
F - TMVW-i	MT20	4.0	4.0	2.00 1.75
G - TMVW-p	MT20	5.0	8.0	Edge 3.50
H - BMV-i-p	MT20	3.0	4.0	
I - BMVW-i	MT20	5.0	6.0	2.50 2.50
J - BS-i	MT20	3.0	6.0	
K - BMVW-i	MT20	4.0	4.0	
L - BMVW-w-i	MT20	4.0	4.0	
M - BMVW-i	MT20	4.0	4.0	
N - BS-i	MT20	3.0	6.0	
O - BMVW-i	MT20	5.0	6.0	2.50 2.50
P - BMV-i-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORZ	UPLIFT
P	1920	0	0	3-8
H	1920	0	0	3-8

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
P	1358	891 0
H	1358	891 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.64 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF 8-M, D-L, F-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING	CHORDS	WEBS
	MAX. FACTORED	MAX. FACTORED
	MEMB. FORCE (LBS)	MEMB. FORCE (LBS)
	FROM TO	FROM TO
	FR-TO	FR-TO
	A-B	-2510 0
	B-C	-2113 0
	C-D	-1919 0
	D-E	-1919 0
	E-F	-2113 0
	F-G	-2510 0
	P-A	-1868 0
	H-G	-1868 0
	P-O	0 0
	O-N	0 2199
	N-M	0 2199
	M-L	0 1797
	L-K	0 1797
	K-J	0 2199
	J-I	0 2199
	I-H	0 0

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.21")

CSI: TC=0.71 1.00 (A-B:1), BC=0.45 1.00 (M-O:1), WB=0.50 1.00 (A-O:1), SSI=0.26 1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1650

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.84 (I) (INPUT = 0.90)
JSI METAL = 0.66 (N) (INPUT = 1.00)




Structural component only
DWG# T-2007638

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T28	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:04:10 2020 Page 1
ID:DMCubINVR6TslFoe31v6l zns11-igYOL6j8q cl45FP4UNTkGGKlpt777_kbX7PuhzMEM2

0.0 5-11.3 5-11.3 5-8.15 11-8.1 12-0.4 14-8.4 16-8.4 17-5.0 23-1.15 28-10.13 34-10.0
1-0.3 2-0.0 2-0.0 8-12.0 5-8.15 5-8.15 5-11.3
Scale = 1/54.8

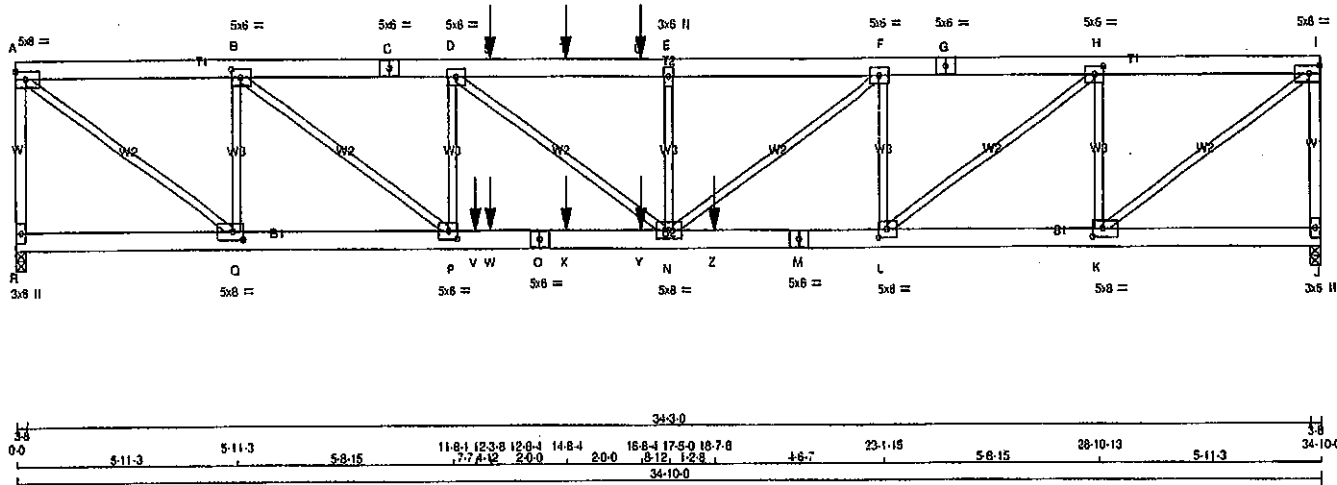

TOTAL WEIGHT = 2 X 183 = 366 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
R - A	2x4 DRY	No.2	SPF		
A - C	2x6 DRY	No.2	SPF		
C - G	2x6 DRY	No.2	SPF		
G - I	2x6 DRY	No.2	SPF		
J - I	2x4 DRY	No.2	SPF		
R - O	2x6 DRY	No.2	SPF		
O - M	2x6 DRY	No.2	SPF		
M - J	2x6 DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2
SPF
DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
R - A	12	TOP
I - J	12	TOP
A - C	12	TOP
C - G	12	TOP
G - I	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
R - O	12	SIDE(0.01)
O - M	12	SIDE(0.01)
M - J	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	3373	3373	0	3-8
R	3373	3373	0	3-8
J	3103	3103	0	3-8

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	2380	1591 0	0 0	0 0	0 0	789 0	0 0
J	2190	1459 0	0 0	0 0	0 0	731 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO									
R-A	3318	0	0.0	0.0	0.58 (1)	6.39	K-I	0	4719
A-B	4149	0	-0.8	-0.8	0.14 (1)	5.47	A-Q	0	5171
B-C	7288	0	-0.8	-0.8	0.20 (1)	4.33	K-H	-2757	0
C-D	7288	0	-0.8	-0.8	0.20 (1)	4.33	Q-B	-2997	0
D-S	8278	0	-0.8	-0.8	0.28 (1)	4.03	L-H	0	3530
S-T	8278	0	-0.8	-0.8	0.28 (1)	4.03	B-P	0	3958
T-U	8278	0	-0.8	-0.8	0.28 (1)	4.03	L-F	-1791	0
U-E	8278	0	-0.8	-0.8	0.28 (1)	4.03	P-D	-1403	0
E-F	8278	0	-0.8	-0.8	0.21 (1)	4.11	N-F	0	2134
F-G	8586	0	-0.8	-0.8	0.19 (1)	4.52	D-N	0	1249
G-H	8586	0	-0.8	-0.8	0.19 (1)	4.52	N-E	-673	0
H-I	3787	0	-0.8	-0.8	0.13 (1)	5.68			
J-I	-3042	0	0.0	0.0	0.51 (1)	6.82			

R-Q	0	0	-18.5	-18.5	0.04 (4)	10.00
Q-P	0	4149	-18.5	-18.5	0.30 (1)	10.00
P-V	0	7288	-18.5	-18.5	0.87 (1)	10.00
V-W	0	7288	-18.5	-18.5	0.87 (1)	10.00
W-O	0	7288	-18.5	-18.5	0.87 (1)	10.00
O-X	0	7288	-18.5	-18.5	0.87 (1)	10.00
X-Y	0	7288	-18.5	-18.5	0.87 (1)	10.00
Y-N	0	7288	-18.5	-18.5	0.87 (1)	10.00
N-Z	0	8586	-18.5	-18.5	0.72 (1)	10.00
Z-M	0	8586	-18.5	-18.5	0.72 (1)	10.00
M-L	0	8586	-18.5	-18.5	0.72 (1)	10.00
L-K	0	3787	-18.5	-18.5	0.32 (1)	10.00
K-J	0	0	-18.5	-18.5	0.04 (4)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
S	12-8-4	-88	-88	---	BACK	VERT	TOTAL	---	C1
T	14-8-4	-88	-88	---	BACK	VERT	TOTAL	---	C1
U	16-8-4	-88	-88	---	BACK	VERT	TOTAL	---	C1
V	12-3-8	-1052	-1052	---	BACK	VERT	TOTAL	---	C1
W	12-8-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
X	14-8-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
Y	16-8-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
Z	18-7-8	-1273	-1273	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.8	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.18")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CSI: TC=0.56:1.00 (A-R:1), SC=0.72:1.00 (L-N:1),
WB=0.64:1.00 (A-Q:1), SSI=0.37:1.00 (L-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (1) INPUT = 0.90 1
JSI METAL = 0.73 (1) INPUT = 1.00 1



Structural component only
DWG# T-2007639 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T28	1	2	TRUSS DESC.		

Tamajack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 M Tek Industries, Inc. Tue Apr 28 10:04:10 2020 Page 2


ID:DMCubINVR6TsFos3Iv6I zns1I-IqYGL68g CL45FP4UNTKGKlp1777 kbX7Puh2MEM2

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWW-I	MT20	5.0	8.0	2.50	3.25
B	TMWW-I	MT20	5.0	6.0	2.50	2.75
C	TS-I	MT20	5.0	6.0		
D	TMWW-I	MT20	5.0	6.0		
E	TMWW-w	MT20	3.0	8.0		
F	TMWW-I	MT20	5.0	8.0		
G	TS-I	MT20	5.0	6.0		
H	TMWW-I	MT20	5.0	8.0	2.50	2.75
I	TMWW-I	MT20	5.0	8.0	2.50	3.25
J	BMVI+p	MT20	3.0	6.0		
K	BMWW-I	MT20	5.0	8.0	2.50	3.25
L	BMWW-I	MT20	5.0	6.0	2.50	2.75
M	BS-I	MT20	5.0	6.0		
N	BMWW-I	MT20	5.0	8.0		
O	BS-I	MT20	5.0	6.0		
P	BMWW-I	MT20	5.0	6.0	2.50	2.75
Q	BMWW-I	MT20	5.0	8.0	2.50	3.25
R	BMVI+p	MT20	3.0	6.0		

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER MECHANICAL CONNECTION IS REQUIRED.

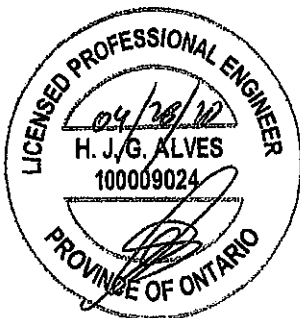


Structural component only
DWG# T-2007639 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T29	2	1	TRUSS DESC.		

Tanarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Tue Apr 28 10:04:11 2020 Page 1
ID:DMCubINVR6TstFoe31v8l zns11-As8eYSkmbkCfQbeBuiGUoUPDIsbAlpBtyR/zMEMY

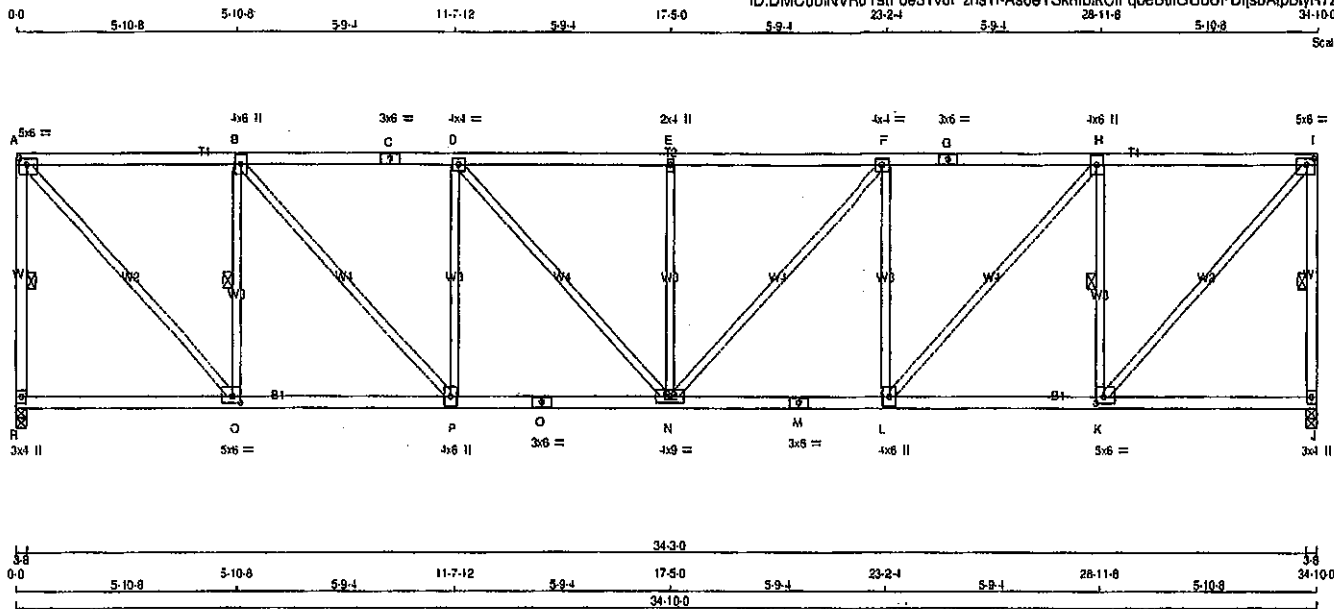

TOTAL WEIGHT = 2 X 157 = 314 lb

N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
R - A	2x4	DRY	No.2	
A - C	2x4	DRY	No.2	
C - G	2x4	DRY	No.2	
G - I	2x4	DRY	No.2	
J - I	2x4	DRY	No.2	
R - O	2x4	DRY	No.2	
O - M	2x4	DRY	No.2	
M - J	2x4	DRY	No.2	

ALL WEBS 2x3 DRY
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A TMWW-1	MT20	5.0	6.0	2.00	2.50
B TMWW-1	MT20	4.0	6.0		
C TS-1	MT20	3.0	6.0		
D TMWW-1	MT20	4.0	6.0		
E TMWW-1	MT20	2.0	4.0		
F TMWW-1	MT20	4.0	6.0		
G TS-1	MT20	3.0	6.0		
H TMWW-1	MT20	4.0	6.0		
I TMWW-1	MT20	5.0	6.0	2.00	2.50
J BMV-1-p	MT20	3.0	4.0		
K BMVW-1	MT20	5.0	6.0	2.00	2.50
L BMVW-1	MT20	4.0	6.0		
M BS-1	MT20	3.0	6.0		
N BMVW-1	MT20	4.0	6.0		
O BS-1	MT20	3.0	6.0		
P BMVW-1	MT20	4.0	6.0		
Q BMVW-1	MT20	5.0	6.0	2.00	2.50
R BMV-1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	IN-SX	IN-SX
R	1920	0	3-8	3-8
J	1920	0	3-8	3-8

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1358	891	0	0	0	467	0
J	1358	891	0	0	0	467	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-R, I-J, B-Q, H-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED	MAX
MEMB.	FORCE (LBS)	VERT. (PLF)	CS1 (LC)	UNBRAC	FR-TO	FR-TO	LENGTH	FR-TO	CS1 (LC)
R-A	-1876	0	0.0	0.0	0.37 (1)	4.90	A-Q	0	2281
A-B	-1563	0	-91.8	-91.8	0.53 (1)	4.81	Q-B	-1540	0
B-C	-2426	0	-91.8	-91.8	0.63 (1)	3.77	B-P	0	1272
C-D	-2426	0	-91.8	-91.8	0.63 (1)	3.77	P-D	-831	0
D-E	-2725	0	-91.8	-91.8	0.56 (1)	3.72	D-N	0	440
E-F	-2725	0	-91.8	-91.8	0.56 (1)	3.72	N-E	-539	0
F-G	-2426	0	-91.8	-91.8	0.63 (1)	3.77	N-F	0	440
G-H	-2426	0	-91.8	-91.8	0.63 (1)	3.77	L-F	-831	0
H-I	-1563	0	-91.8	-91.8	0.53 (1)	4.81	L-H	0	1272
J-I	-1876	0	0.0	0.0	0.37 (1)	4.90	K-H	-1540	0
R-Q	0	0	-18.5	-18.5	0.15 (4)	10.00	K-I	0	2281
Q-P	0	1563	-18.5	-18.5	0.33 (1)	10.00			
P-O	0	2426	-18.5	-18.5	0.44 (1)	10.00			
O-N	0	2426	-18.5	-18.5	0.44 (1)	10.00			
N-M	0	2426	-18.5	-18.5	0.44 (1)	10.00			
M-L	0	2426	-18.5	-18.5	0.44 (1)	10.00			
L-K	0	1563	-18.5	-18.5	0.33 (1)	10.00			
K-J	0	0	-18.5	-18.5	0.15 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TRIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.18")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.31")

CS1: TC=0.63/1.00 (F-H:1), BC=0.44/1.00 (N-P:1),
WB=0.58/1.00 (F-L:1), SS=0.25/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX	MIN	MAX
MT20	618	354
	1667	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (A) (INPUT = 0.90)
JSI METAL = 0.78 (A) (INPUT = 1.00)




Structural component only
DWG# T-2007640

JOB NAME 408223	TRUSS NAME T30	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 5 Oct 2019 MTak Industries, Inc. Tue Apr 28 10:04:12 2020 Page 1

ID:DMCubINVR6TstFoe31v6l.zns1f-e3q0mokOmbs3JPPnBvPxpHb5cd.b7s02rcVzZMEMX

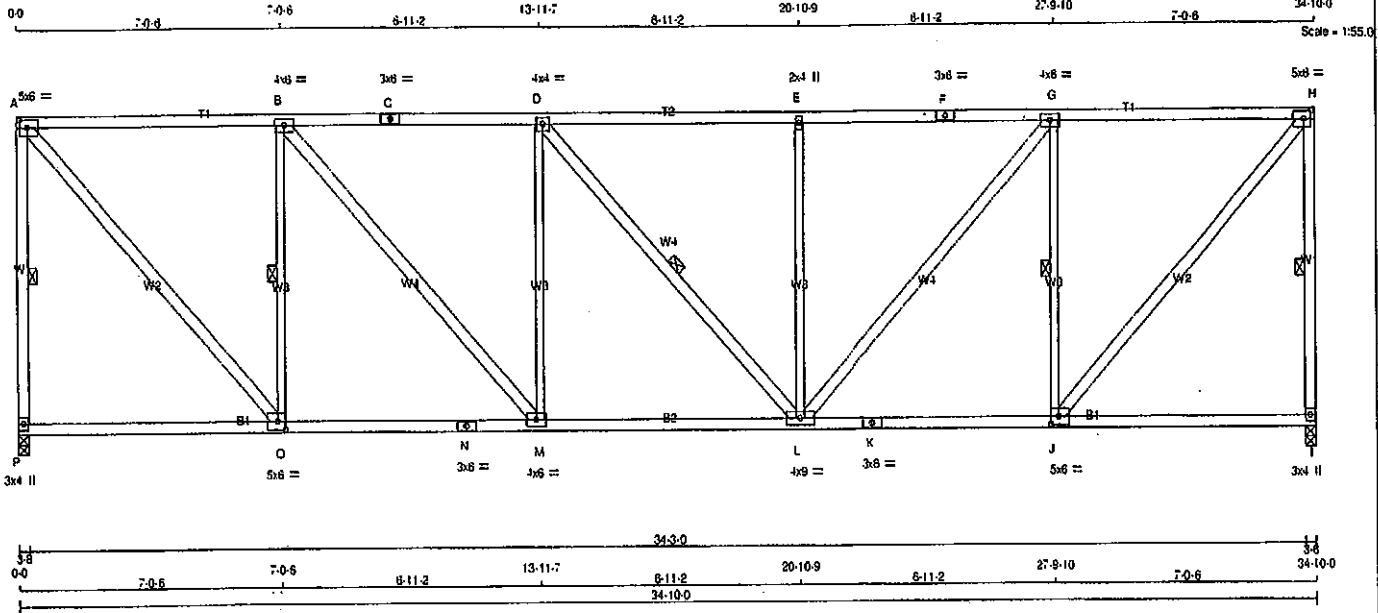

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	DRY	No.2	SPF
P - A	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
C - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
P - N	2x4	DRY	No.2	SPF	
N - K	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x4	DRY	No.2	SPF	
O - B	2x3	DRY	No.2	SPF	
M - D	2x3	DRY	No.2	SPF	
L - E	2x3	DRY	No.2	SPF	
J - G	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A - TMWW-t	MT20	5.0	6.0	2.50	2.50
B - TMWW-t	MT20	4.0	6.0		
C - TS-t	MT20	3.0	6.0		
D - TMWW-t	MT20	4.0	4.0		
E - TMWW-t	MT20	2.0	4.0		
F - TS-t	MT20	3.0	6.0		
G - TMWW-t	MT20	4.0	6.0		
H - TMWW-t	MT20	5.0	6.0	2.50	2.50
I - BMV1+p	MT20	3.0	4.0		
J - BMWW-t	MT20	5.0	6.0	2.50	2.50
K - BS-t	MT20	3.0	6.0		
L - BMWW-t	MT20	4.0	9.0		
M - BMWW-t	MT20	4.0	6.0		
N - BS-t	MT20	3.0	6.0		
O - BMWW-t	MT20	5.0	6.0	2.50	2.50
P - BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	DOWN	UPLIFT	BRG	BRG
P	1920	0	1920	0	0	0	3-8	3-8	3-8
I	1920	0	1920	0	0	0	3-8	3-8	3-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
P	1358	891	0	0	0	0	0
I	1358	891	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.60 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-P, H-I, B-O, D-L, G-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
P-A	-1868 0	A-O	0 2156 0.35 (1)
A-B	-1432 0	B-M	0 986 0.16 (1)
B-C	-2081 0	M-D	-617 0 0.81 (1)
C-D	-2081 0	D-L	-2 0 0.00 (1)
D-E	-2080 0	E-H	-616 0 0.81 (1)
E-F	-2080 0	F-G	0 984 0.16 (1)
F-G	-2080 0	G-J	-1465 0 0.82 (1)
G-H	-1432 0	H-I	0 2156 0.35 (1)
H-I	-1868 0		
P-O	0 0		
O-N	0 1432		
N-M	0 1432		
M-L	0 2081		
L-K	0 1432		
K-J	0 1432		
J-I	0 0		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.16")
CALCULATED VERT. DEFL. (LL) = L/999 (0.12")
ALLOWABLE DEFL. (TL) = L/360 (1.16")
CALCULATED VERT. DEFL. (TL) = L/999 (0.24")

CS: TC=0.89/1.00 (E-G:1), BC=0.42/1.00 (L-M:1), WB=0.81/1.00 (D-M:1), SS=0.30/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1067 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (H) INPUT = 0.90
JSI METAL= 0.46 (K) INPUT = 1.00



Structural component only
DWG# T-2007641

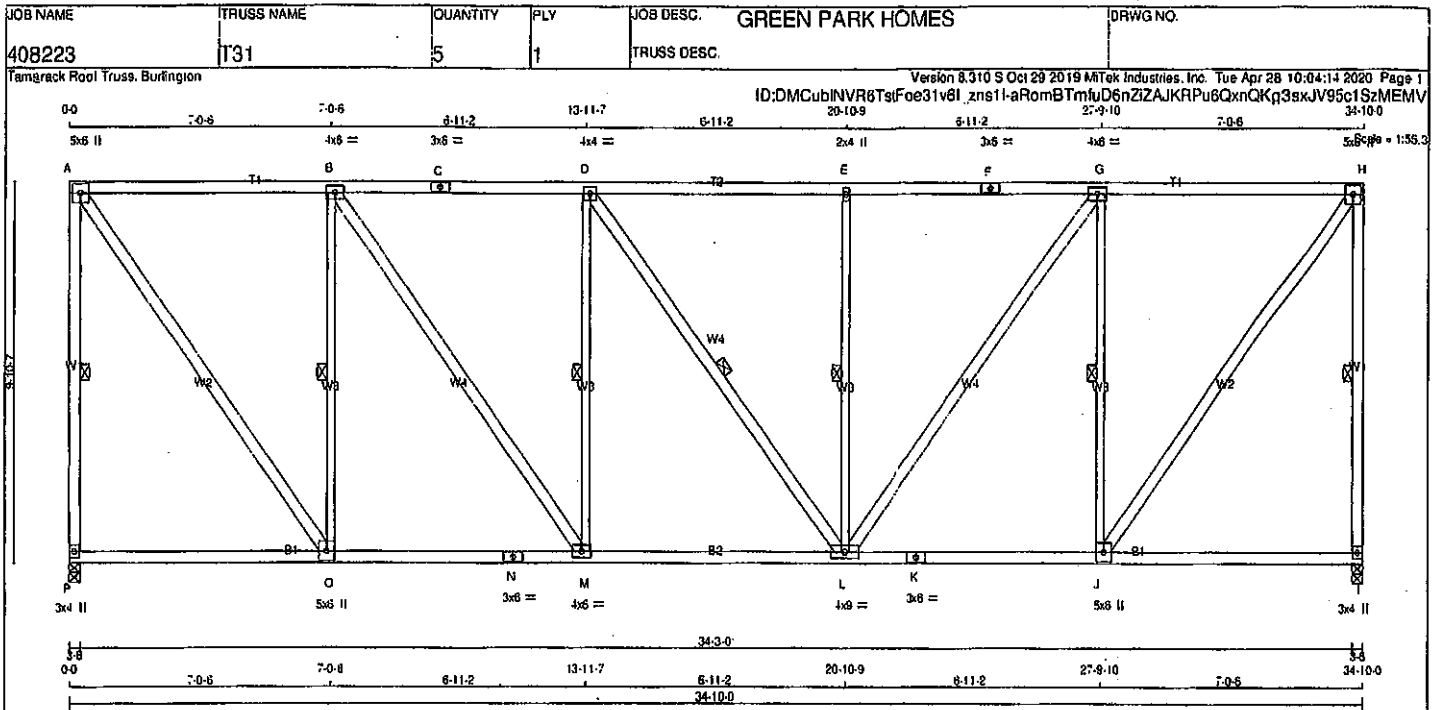

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
P - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
I - H	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
ALL WEBS	2x4	DRY	No.2
EXCEPT			
O - B	2x3	DRY	No.2
M - D	2x3	DRY	No.2
L - E	2x3	DRY	No.2
J - G	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	5.0	6.0		
B	TMVW-i	MT20	4.0	6.0		
C	TS-i	MT20	3.0	6.0		
D	TMVW-i	MT20	4.0	4.0		
E	TMVW+w	MT20	2.0	4.0		
F	TS-i	MT20	3.0	6.0		
G	TMVW-i	MT20	4.0	6.0		
H	TMVW+p	MT20	5.0	6.0		
I	BMV1+p	MT20	3.0	4.0		
J	BMVW+i	MT20	5.0	6.0		
K	BS-i	MT20	3.0	6.0		
L	BMVW+i	MT20	4.0	9.0		
M	BMVW-i	MT20	4.0	6.0		
N	BS-i	MT20	3.0	6.0		
O	BMVW+i	MT20	5.0	6.0		
P	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
P	1920	0	1920	0	3-8	3-8
I	1920	0	1920	0	3-8	3-8

UNFACTORED REACTIONS

JT	1ST CASE		MAX. MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
P	1358	891	0	0	0	487	0
I	1358	891	0	0	0	487	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.96 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-P, H-I, B-Q, D-M, D-L, E-L, G-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LOAD LC1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 LC		
FR-TO		FROM TO			FR-TO				
P-A	-1888 0	0.0	0.0	0.88 (1)	A-O	0	1999 0.32 (1)		
A-B	-1183 0	-91.8	-91.8	0.75 (1)	O-B	-1488 0	0.96 (1)		
B-C	-1719 0	-91.8	-91.8	0.82 (1)	B-M	0	916 0.15 (1)		
C-D	-1719 0	-91.8	-91.8	0.82 (1)	M-D	-617 0	0.41 (1)		
D-E	-1718 0	-91.8	-91.8	0.83 (1)	D-L	-2 0	0.00 (1)		
E-F	-1718 0	-91.8	-91.8	0.83 (1)	L-E	-618 0	0.41 (1)		
F-G	-1718 0	-91.8	-91.8	0.83 (1)	G-L	0	813 0.15 (1)		
G-H	-1183 0	-91.8	-91.8	0.75 (1)	J-G	-1485 0	0.96 (1)		
H-I	-1888 0	0.0	0.0	0.88 (1)	J-H	0	2000 0.32 (1)		
P-O	0	0	-18.5	-18.5	0.22 (4)	10.00			
O-N	0	1183	-18.5	-18.5	0.32 (4)	10.00			
N-M	0	1183	-18.5	-18.5	0.32 (4)	10.00			
M-L	0	1719	-18.5	-18.5	0.36 (1)	10.00			
L-K	0	1183	-18.5	-18.5	0.32 (4)	10.00			
K-J	0	1183	-18.5	-18.5	0.32 (4)	10.00			
J-I	0	0	-18.5	-18.5	0.22 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CS1: TC=0.88/1.00 (H-I), BC=0.36/1.00 (L-M), WB=0.99/1.00 (B-C), SS1=0.30/1.00 (G-H)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (H) (INPUT = 0.90)
JSI METAL = 0.43 (H) (INPUT = 1.00)



Structural component only
DWG# T-2007642



TOTAL WEIGHT = 66 lb

DRY: SEASONED LUMBER.

PLATES (table in inches)

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARING

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 3'-8".

UNFACTORED REACTIONS

1ST LCASE MA

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED

LOADING

TOTAL LOAD CASES: 14)

CHORDS:

FACTORED C

CONNECTION REQUIREMENTS

11 C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL =

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.41")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.41")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.51 (C-D:1), BC=0.28 (F-G:1),
WB=0.20 (A-G:1), SSI=0.20 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
-------	--------------------	----------------	------------------

	MAX	MIN	MAX	MIN	MAX	MIN
MT20	818	354	1667	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg


JSI GRIP= 0.78 (D) (INPUT = 0.90)
JSI METAL= 0.23 (D) (INPUT = 1.00)



Structural component only
DWG# T-2007643

Tek Industries

Scale = 1:30,1



JSI GRIP = 0.24 (B) (INPUT = 0.80)
JSI METAL = 0.06 (B) (INPUT = 1.00)




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T35S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:17 2020 Page 1

ID:DMCubINVR6TslF0e31v61_zns1f-0TvpVoXB6UMQAH1_S76W12dVdRQGSEmC7KGenzMEMS

Scale = 1/23.4

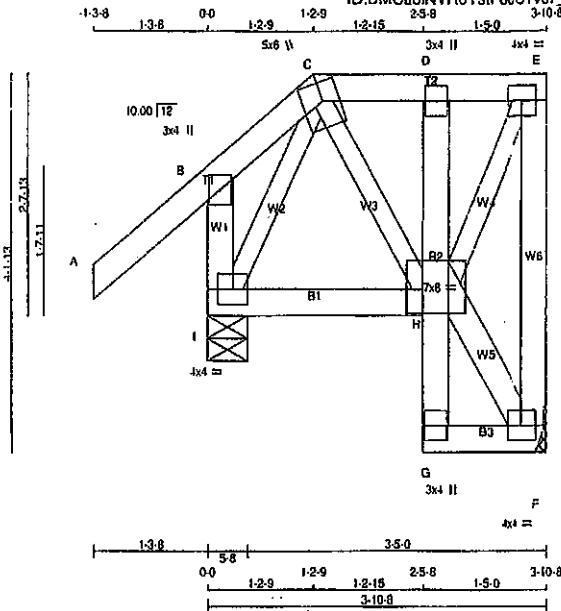

TOTAL WEIGHT = 2 X 29 = 57 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
I - B	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
G - D	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT H - F	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TTWW+m	MT20	5.0	6.0	2.50	2.25
D	TMV+p	MT20	3.0	4.0		
E	TMVW-i	MT20	4.0	4.0		
F	BMVW-i	MT20	4.0	4.0		
G	BMV+p	MT20	3.0	4.0		
H	BMVWW-i	MT20	7.0	8.0	3.25	2.25
I	BMVW-i	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UP
F	191	0	191	0
I	363	0	363	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS							
	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	135	88 -13	0 0	0 0	0 0	49 0	0 0
I	254	183 0	0 0	0 0	0 0	72 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 41	-91.8 -91.8 0.14 (5)	H-F	-6 0
B-C	-45 0	-91.8 -91.8 0.14 (5)	H-E	0 141
C-D	-69 0	-91.8 -91.8 0.02 (1)	C-H	0 48
D-E	-87 0	-91.8 -91.8 0.02 (1)	I-C	-98 28
F-E	-175 0	0.0 0.0 0.05 (1)		
I-B	-255 0	0.0 0.0 0.03 (1)		
I-H	-13 45	-18.5 -18.5 0.04 (4)		
G-H	0 13	0.0 0.0 0.01 (1)		
H-D	-135 0	0.0 0.0 0.01 (1)		
G-F	0 4	-18.5 -18.5 0.01 (4)		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9. NBCC 2010. NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 089-09, CSA 089-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14+1.00 (A-B-5), BC=0.04+1.00 (H-I-4), WB=0.03+1.00 (E-H-1), SS=0.09+1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (E) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007645


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T36	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 M/Tek Industries, Inc. Tue Apr 28 10:04:18 2020 Page 1

ID:DMCubINVR6TslFoe31v8l zns11-TC1H0rpyRcdIKsxY9WL2yba51j27vNvQn3qBDzMEMR

Scale = 1:18.9

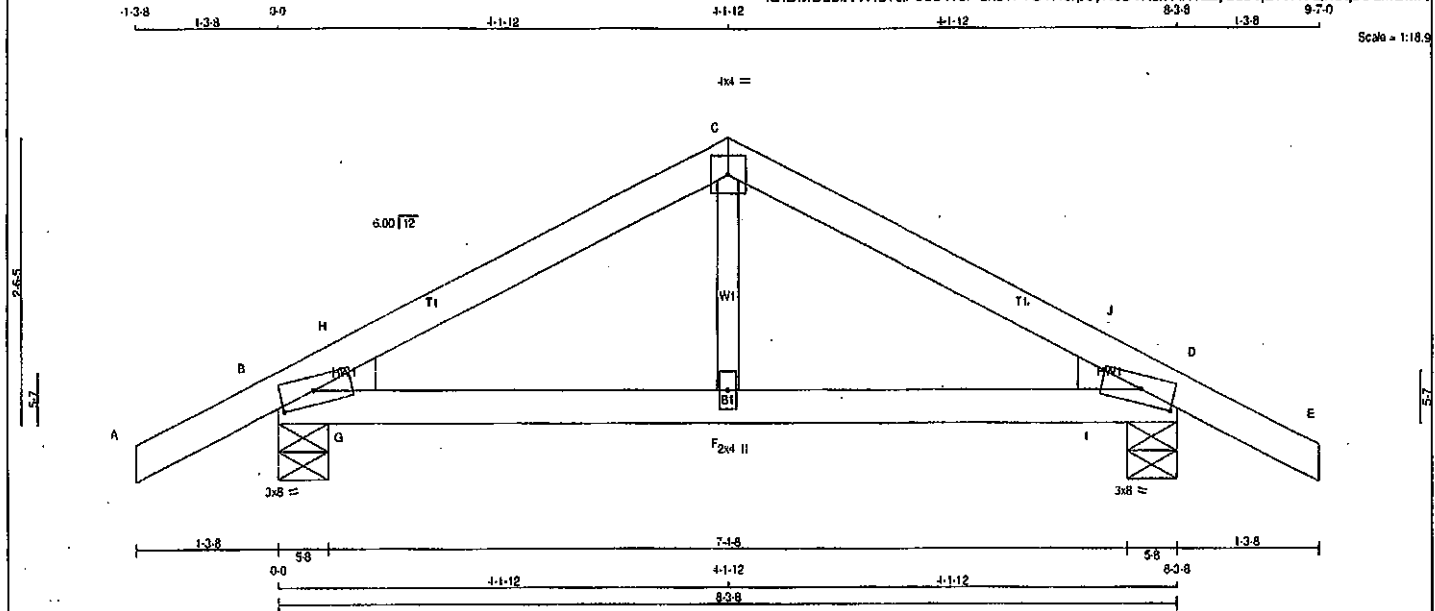

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES				
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
B - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMBH1-m	MT20	3.0	8.0	1.50	3.75
C	TTW-p	MT20	4.0	4.0		
D	TMBH1-m	MT20	3.0	8.0	1.50	3.75
F	BMW-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	UPLIFT	HEEL
B	582	0	582	0
D	582	0	582	0

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL
B	409 282 0 0 0 0 0 0 127 0 0 0
D	409 282 0 0 0 0 0 0 127 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 23	-91.8 -91.8	0.12 (1)	10.00	F-C	0 170	0.04 (1)
B-H	-539 0	-91.8 -91.8	0.04 (1)	8.25	G-H	-158 3	0.00 (1)
H-C	-525 0	-91.8 -91.8	0.15 (1)	8.25	I-J	-158 3	0.00 (1)
C-J	-525 0	-91.8 -91.8	0.15 (1)	8.25			
J-D	-539 0	-91.8 -91.8	0.04 (1)	8.25			
D-E	0 23	-91.8 -91.8	0.12 (1)	10.00			
B-G	0 465	-18.5 -18.5	0.21 (1)	10.00			
G-F	0 465	-18.5 -18.5	0.21 (1)	10.00			
F-I	0 465	-18.5 -18.5	0.21 (1)	10.00			
I-O	0 465	-18.5 -18.5	0.21 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.28")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.15/1.00 (C-J:1), BC=0.21/1.00 (F-I:1), WB=0.04/1.00 (C-F:1), SS=0.12/1.00 (C-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.25 (B) (INPUT = 0.90)
JSI METAL = 0.11 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007646

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	G36	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:03:49 2020 Page 1			
		ID:DMCubINVR6TstFoe31v6l_zns1l-pdnKxwTznXyK3l8MLaVXNrbLl5loKemmYnfpZMEMu			
		Scale = 1:19.1			

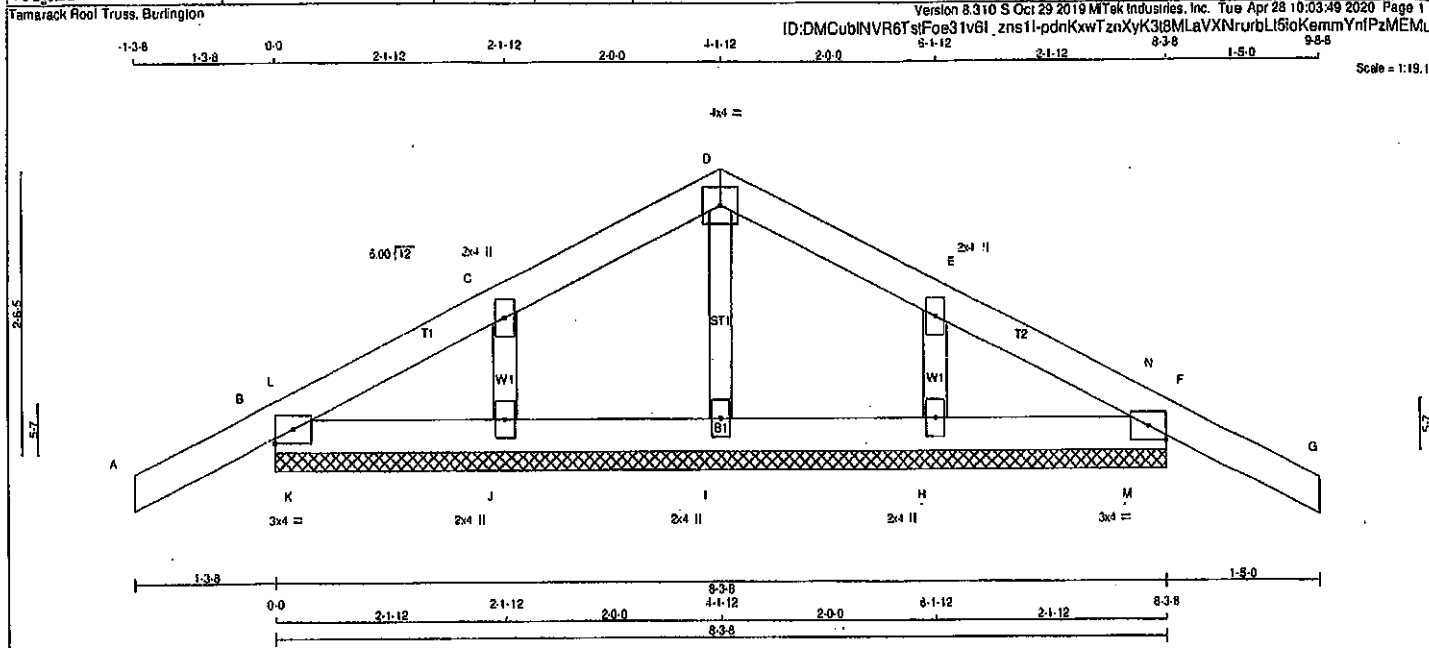

TOTAL WEIGHT = 27 k

[M

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2 SPF
D - G	2x4	DRY	No.2 SPF
B - F	2x4	DRY	No.2 SPF
ALL WEBS	2x3	DRY	No.2 SPF
ALL GABLE WEBS	2x3	DRY	No.2 SPF
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0		Edge
C	TMW+w	MT20	2.0	4.0		
D	ITW-p	MT20	4.0	4.0		
E	TMW+w	MT20	2.0	4.0		
F	TMB1-I	MT20	3.0	4.0		Edge
H, I, J						
H	BMW1+w	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0 23	-81.8 -81.8 0.12 (1)	10.00	I-D	-115 0	0.02 (1)	
B-L	-81 0	-81.8 -81.8 0.01 (4)	6.25	J-C	-218 0	0.03 (1)	
L-C	-39 0	-81.8 -81.8 0.06 (1)	6.25	H-E	-218 0	0.03 (1)	
C-D	-45 0	-81.8 -81.8 0.06 (1)	6.25	K-L	-52 7	0.00 (1)	
D-E	-45 0	-81.8 -81.8 0.06 (1)	6.25	M-N	-52 7	0.00 (1)	
E-N	-39 0	-81.8 -81.8 0.06 (1)	6.25				
N-F	-61 0	-81.8 -81.8 0.01 (4)	6.25				
F-G	0 25	-81.8 -81.8 0.14 (1)	10.00				
B-K	0 44	-18.5 -18.5 0.03 (1)	10.00				
K-J	0 44	-18.5 -18.5 0.03 (1)	10.00				
J-I	0 32	-18.5 -18.5 0.02 (1)	10.00				
I-H	0 32	-18.5 -18.5 0.02 (1)	10.00				
H-M	0 44	-18.5 -18.5 0.03 (1)	10.00				
M-F	0 44	-18.5 -18.5 0.03 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.14/1.00 (F-G:1), BC=0.03/1.00 (H-M:1), WB=0.03/1.00 (E-H:1), SS=0.10/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1657 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (8) (INPUT = 0.90)
JSI METAL = 0.09 (C) (INPUT = 1.00)

Structural component only
DWG# T-2007621




Structural component only
DWG# T-2007621

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T37	1	1	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTak Industries, Inc. Tue Apr 28 10:04:19 2020 Page 1
ID:DMCubINVR6TstFos31v6I_zns11-xPbIEBqnik4fUR78t1fabA7yUR47k1zMEMQ

Scale = 1:17.0

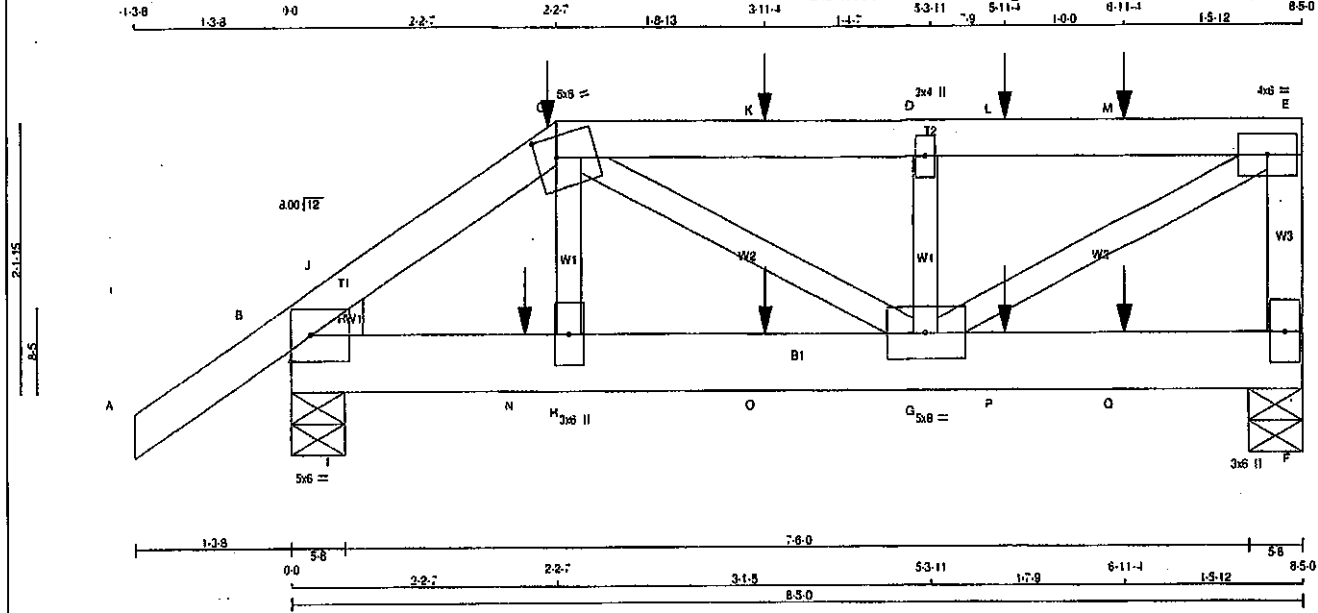

TOTAL WEIGHT = 37 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - E	2x4	DRY	No.2	SPF		
F - E	2x4	DRY	No.2	SPF		
B - F	2x6	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
DRY: SEASONED LUMBER.						

PLATES (table in inches)	TYPE	PLATES	W	LEN	Y	X
JT	TMH1-I	MT20	5.0	6.0	Edge	
B	TTWW-m	MT20	5.0	6.0	2.00	2.00
C	TMW-w	MT20	2.0	4.0		
D	TMW-w	MT20	4.0	6.0		
F	BMV1-p	MT20	3.0	6.0		
G	BMWVW-w	MT20	5.0	6.0		
H	BMW-w	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	HEEL WEDGE
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
F	760	0	760	0	0
B	823	0	823	0	0

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	352.0	0.0	0.0	0.0	185.0	0.0
F	580	392.0	0.0	0.0	0.0	188.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CS1 (LC)	MEMB.	FORCE (LBS)
FR-TO		FROM TO		FR-TO	
A-B	0 26	-91.8 -91.8 0.13 (1)	10.00	H-C	0 73
B-J	-1068 0	-91.8 -91.8 0.08 (1)	5.99	C-G	0 252
J-C	-860 0	-91.8 -91.8 0.08 (1)	6.25	G-D	-528 0
C-K	-923 0	-91.8 -91.8 0.24 (1)	6.09	G-E	0 1062
K-D	-923 0	-91.8 -91.8 0.24 (1)	6.09	I-J	0 207
D-L	-824 0	-91.8 -91.8 0.24 (1)	6.09		
L-M	-824 0	-91.8 -91.8 0.24 (1)	6.09		
M-E	-924 0	-91.8 -91.8 0.24 (1)	6.09		
F-E	-882 0	0.0 0.0 0.08 (1)	7.81		
B-I	0 701	-18.5 -18.5 0.14 (1)	10.00		
I-N	0 701	-18.5 -18.5 0.14 (1)	10.00		
N-H	0 701	-18.5 -18.5 0.14 (1)	10.00		
H-O	0 705	-18.5 -18.5 0.15 (1)	10.00		
O-G	0 705	-18.5 -18.5 0.15 (1)	10.00		
G-P	0 0	-18.5 -18.5 0.07 (1)	10.00		
P-Q	0 0	-18.5 -18.5 0.07 (1)	10.00		
Q-F	0 0	-18.5 -18.5 0.07 (1)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
O	2-2.7	-88	-88	---	FRONT	VERT	TOTAL	C1
K	3-11.4	-83	-83	---	FRONT	VERT	TOTAL	C1
L	5-11.4	-83	-83	---	FRONT	VERT	TOTAL	C1
M	6-11.4	-83	-83	---	FRONT	VERT	TOTAL	C1
N	1-11.4	-48	-48	---	FRONT	VERT	TOTAL	C1
O	3-11.4	-48	-48	---	FRONT	VERT	TOTAL	C1
P	5-11.4	-48	-48	---	FRONT	VERT	TOTAL	C1
Q	6-11.4	-48	-48	---	FRONT	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.28")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.28")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSK: TC=0.24/1.00 (D-E:1), SC=0.15/1.00 (G-H:1),
WB=0.26/1.00 (E-G:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1897

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.61 (E) (INPUT = 0.90)
JSI METAL= 0.24 (E) (INPUT = 1.00)

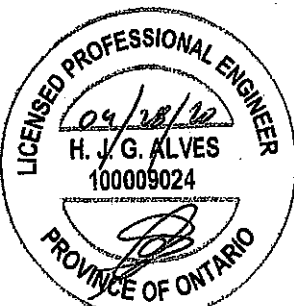

Structural component only
DWG# T-2007647

JOB NAME 408224	TRUSS NAME T40	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:19:57 2020 Page 1	
ID:DMCubINVR6TstFoe31v6l_zns11-TsGG5wA9pyw_Bd8P2lsXcz_APYAIVTa7LN1d1zME7m				352.0 38.5 13.8	
				Scale = 1:57.6	

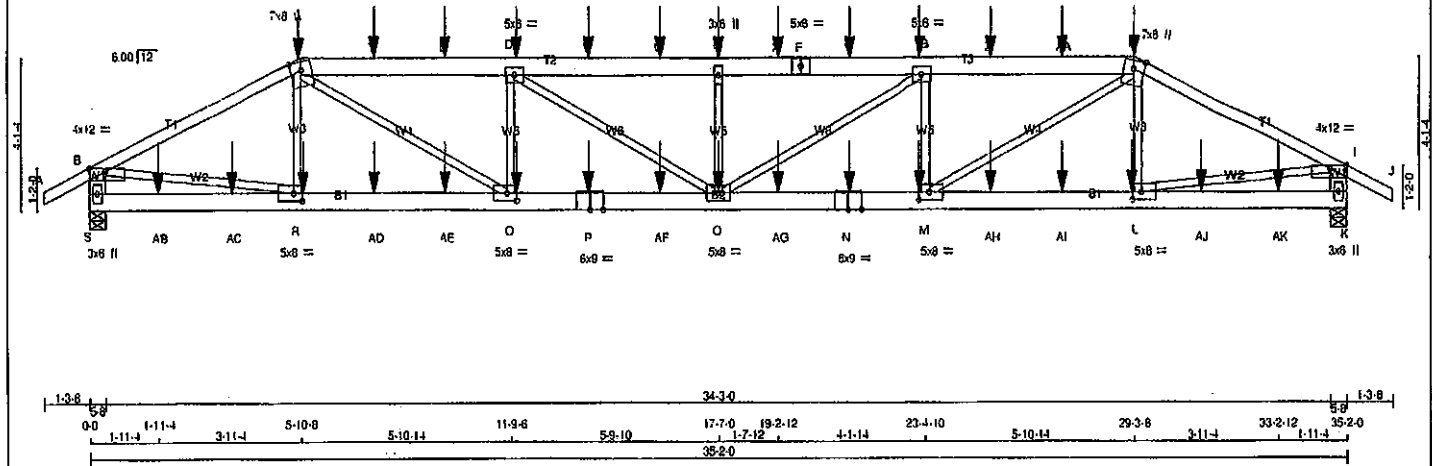

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. SPF A - C 2x4 DRY No.2 8PF C - F 2x8 DRY No.2 8PF F - H 2x8 DRY No.2 8PF H - J 2x4 DRY No.2 8PF S - B 2x8 DRY No.2 8PF K - I 2x8 DRY No.2 8PF P - N 2x8 DRY 1650F 1.5E 8PF S - N 2x8 DRY 1650F 1.5E 8PF N - K 2x8 DRY 1650F 1.5E 8PF ALL WEBS 2x3 DRY No.2 8PF EXCEPT DRY, SEASONED LUMBER. DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS: CHORDS #ROWS SURFACE SPACING (IN) LOAD (PLF) TOP CHORDS : (0.122"x3") SPIRAL NAILS A-C 1 12 SIDE(61.0) H-J 1 12 SIDE(61.0) C-F 2 12 SIDE(183.1) F-H 2 12 SIDE(183.1) S-B 2 12 TOP K-I 2 12 TOP BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS P-N 2 12 SIDE(183.1) S-N 2 12 SIDE(183.1) N-K 2 12 SIDE(183.1) WEBS : (0.122"x3") SPIRAL NAILS 2x3 1 6 NAILS TO BE DRIVEN FROM ONE SIDE ONLY. GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS. TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED MAXIMUM FACTORED INPUT REQD GROSS REACTION GROSS REACTION BRG BRG JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX S 3323 0 3323 0 0 5-8 5-8 K 3323 0 3323 0 0 5-8 5-8 UNFACTORED REACTIONS 1ST LCASE MAX. MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL S 2350 1539 0 0.0 0 0 0 811 0 0 K 2350 1539 0 0.0 0 0 0 811 0 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.87 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS FACTORED WEBS MEMB. MAX. FACTORED FORCE VERT. LOAD LC1 MAX. MAX. MEMB. MAX. FACTORED FORCE VERT. LOAD LC1 MAX. MAX. (LBS) (PLF) CSI (LC) UNBRAC (LBS) CSI (LC) FR-TO LENGTH FR-TO A-B 0 28 -91.8 -91.8 0.07 (1) 10.00 R-C -413 20 0.05 (1) B-C -5065 0 -91.8 -91.8 0.52 (1) 3.87 C-Q 0 3193 0.40 (1) C-T -7264 0 -91.8 -91.8 0.27 (1) 4.26 C-D -1500 0 0.18 (1) T-U -7264 0 -91.8 -91.8 0.27 (1) 4.26 D-O 0 946 0.12 (1) U-D -7264 0 -91.8 -91.8 0.27 (1) 4.26 O-E -830 0 0.10 (1) D-V -8064 0 -91.8 -91.8 0.27 (1) 4.08 C-G 0 -946 0.12 (1) V-W -8064 0 -91.8 -91.8 0.27 (1) 4.08 M-G -1500 0 0.18 (1) W-E -8064 0 -91.8 -91.8 0.27 (1) 4.08 M-H 0 3193 0.40 (1) E-X -8064 0 -91.8 -91.8 0.27 (1) 4.08 L-H -413 20 0.05 (1) X-F -8064 0 -91.8 -91.8 0.27 (1) 4.08 B-R 0 4582 0.57 (1) F-Y -8064 0 -91.8 -91.8 0.27 (1) 4.08 L-I 0 4582 0.57 (1) Y-G -8064 0 -91.8 -91.8 0.27 (1) 4.08 G-Z -7264 0 -91.8 -91.8 0.27 (1) 4.26 Z-AA -7264 0 -91.8 -91.8 0.27 (1) 4.26 AA-H -7264 0 -91.8 -91.8 0.27 (1) 4.26 H-I -5065 0 -91.8 -91.8 0.52 (1) 3.87 I-J 0 28 -91.8 -91.8 0.07 (1) 10.00 S-B -3248 0 0.0 0.0 1.11 (1) 7.69 K-I -3248 0 0.0 0.0 1.11 (1) 7.69 S-B 0 0 -18.5 -18.5 0.04 (4) 10.00 AB-AC 0 0 -18.5 -18.5 0.04 (4) 10.00 AC-P 0 0 -18.5 -18.5 0.04 (4) 10.00 R-AD 0 4553 -18.5 -18.5 0.22 (1) 10.00 AD-AE 0 4553 -18.5 -18.5 0.22 (1) 10.00 AE-O 0 4553 -18.5 -18.5 0.22 (1) 10.00 O-P 0 7263 -18.5 -18.5 0.34 (1) 10.00 P-AF 0 7263 -18.5 -18.5 0.34 (1) 10.00 AF-O 0 7263 -18.5 -18.5 0.34 (1) 10.00 O-AG 0 7263 -18.5 -18.5 0.34 (1) 10.00 AG-N 0 7263 -18.5 -18.5 0.34 (1) 10.00 N-M 0 7263 -18.5 -18.5 0.34 (1) 10.00 MAH 0 4553 -18.5 -18.5 0.22 (1) 10.00 AH-AI 0 4553 -18.5 -18.5 0.22 (1) 10.00 AI-L 0 4553 -18.5 -18.5 0.22 (1) 10.00 L-AJ 0 0 -18.5 -18.5 0.04 (4) 10.00 AJ-AK 0 0 -18.5 -18.5 0.04 (4) 10.00 AK-K 0 0 -18.5 -18.5 0.04 (4) 10.00 FACTORED CONCENTRATED LOADS (LBS) JT LOC. LC1 MAX. MAX. FACE DIR. TYPE HEEL CONN. C 5-10.8 -429 -429 ... FRONT VERT TOTAL ... C1 D 11-11.4 -110 -110 ... FRONT VERT TOTAL ... C1				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 6.0 PSF BOT CH. LL = 6.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF BCBC 2018, CBC 2012, ABC 2019 - PART 9 OF CBC 2012 (2019 AMENDMENT) - CSA 086-08, CSA 086-14 - TPIC 2011, TPIC 2014 .55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL) = L 360 (1.17") CALCULATED VERT. DEFL.(LL) = L 999 (0.21") ALLOWABLE DEFL.(TL) = L 360 (1.17") CALCULATED VERT. DEFL.(TL) = L 999 (0.39") CSI: TC=0.52:1.00 (B-C:1) , BC=0.34:1.00 (O-Q:1) WB=0.57:1.00 (B-R:1) , SS=0.15:1.00 (G-H:1) DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00 COMPANION LIVE LOAD FACTOR = 1.00 AUTOSOLVE HEELS OFF TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. MAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 616 354 1667 788 1987 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.56 (R) (NPUT = 0.90) JSI METAL= 0.56 (P) (NPUT = 1.00)			
--	--	--	--	---	--	--	--	--	--	--	--



Structural component only
DWG# T-2007660 1/2

CONTINUED ON PAGE 2

JOB NAME

408224

TRUSS NAME

T40

QUANTITY

1

PLY

2

JOB DESC.

GREEN PARK HOMES

DRWG NO.

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:57 2020 Page 2

ID:DMCubINVR6TslFoe31v8I_zns1I-TsGG5wA9pyw_Bd8P2isXcz APYAIVTa7LN10dlzME7m

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	4.0	12.0	1.00	5.50
C	TTWW+m	MT20	7.0	8.0	Edge	
D	TMWV-l	MT20	5.0	6.0		
E	TMW+u	MT20	3.0	6.0		
F	T3-l	MT20	5.0	6.0		
G	TMWV-l	MT20	5.0	6.0		
H	TTWW+m	MT20	7.0	8.0	Edge	
I	TMWV-p	MT20	4.0	12.0	1.00	5.50
K	BMV1+p	MT20	3.0	8.0		
L	BMWV-l	MT20	5.0	8.0	2.50	3.00
M	BMWV-l	MT20	5.0	8.0	2.50	3.25
N	BS-l	MT20	6.0	9.0		
O	BMWVW-l	MT20	5.0	8.0		
P	BS-l	MT20	6.0	9.0		
Q	BMWV-l	MT20	5.0	8.0	2.50	3.25
R	BMWV-l	MT20	5.0	8.0	2.50	3.00
S	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	17-7-0	-110	-110	---	FRONT	VERT	TOTAL	---	C1
G	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	29-3-8	-429	-429	---	FRONT	VERT	TOTAL	---	C1
L	29-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
M	23-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
N	21-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
O	17-7-0	-28	-28	---	FRONT	VERT	TOTAL	---	C1
P	13-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
Q	11-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	19-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	1-11-4	-25	-25	---	FRONT	VERT	TOTAL	---	C1
AC	3-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AD	7-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AE	9-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AF	15-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AG	19-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AH	25-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AI	27-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AJ	31-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AK	33-2-12	-25	-25	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

04/28/20

H. J. G. ALVES

100009024

LICENSED PROFESSIONAL ENGINEER

PROVINCE OF ONTARIO

Structural component only


DWG# T-2007660

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T40Z	1	2	GREEN PARK HOMES	
JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:58 2020 Page 1

ID:DMCubINVR6TstF0e31v6I zns11-x2qeJGB0aF2gnjbaNm9BWHeyQ8EpcGa1mZAkzME7I

1-3.8 0-0 5-10.8 5-10.8 5-10.14 11-9.6 5-9.10 17-7.0 18-8.4 20-8.4 22-3.1 23-4.10 29-3.8 5-10.8 35-2.0 36-5.8 1-3.8 Scale = 1:57.6

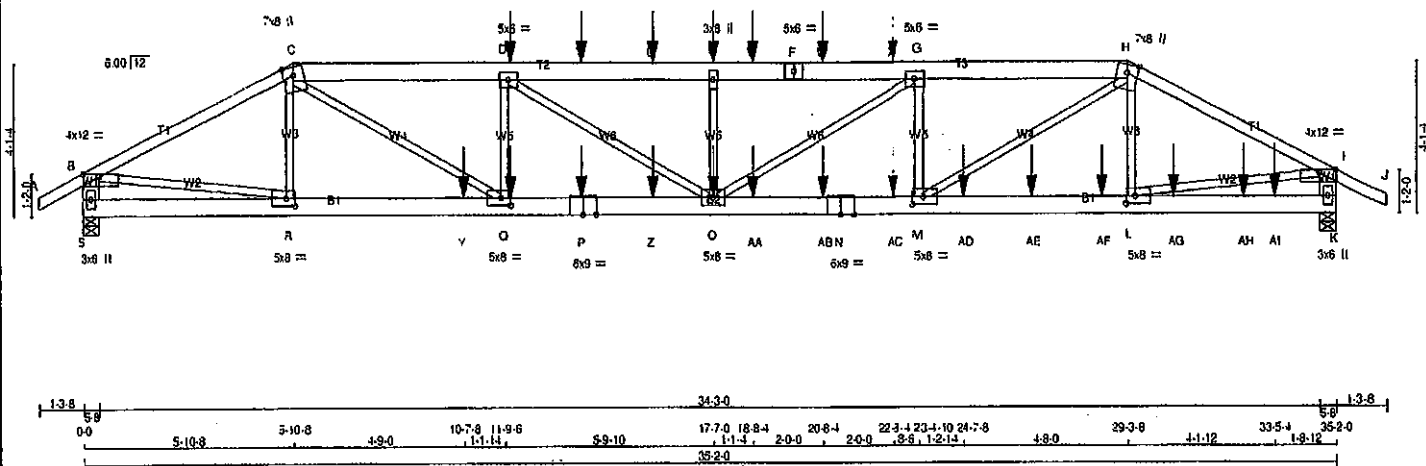

TOTAL WEIGHT = 2 X 189 = 338 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - F	2x6	DRY	No.2	SPF		
F - H	2x6	DRY	No.2	SPF		
H - J	2x4	DRY	No.2	SPF		
S - B	2x6	DRY	No.2	SPF		
K - I	2x6	DRY	No.2	SPF		
S - P	2x6	DRY	1650F 1.5E	SPF		
P - N	2x6	DRY	1650F 1.5E	SPF		
N - K	2x6	DRY	1650F 1.5E	SPF		
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
H - J	12	TOP
C - F	12	SIDE(183.1)
F - H	12	SIDE(0.0)
S - B	12	TOP
K - I	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S - P	12	SIDE(183.1)
P - N	12	SIDE(183.1)
N - K	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER:

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UP	IN-SX
S	4161	0	0	5-8
K	5042	0	0	5-8

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
S	2936	1985 0
K	3552	2409 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.95 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING	MEMB.	CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	CS1 (LC)	UNBRAC	WEBS	MAX. FACTORED	CS1 (LC)
TOTAL LOAD CASES: (4)										
FR-TO										
A-B	0	28	-91.8	-91.8	0.07 (1)	10.00	R-C	-470	0	0.06 (1)
B-C	-6650	0	-91.8	-91.8	0.68 (1)	3.34	C-Q	0	5608	0.69 (1)
C-D	-10735	0	-91.8	-91.8	0.33 (1)	3.55	Q-D	-1678	0	0.20 (1)
D-T	-12119	0	-91.8	-91.8	0.40 (1)	3.30	D-O	0	1636	0.20 (1)
T-U	-12119	0	-91.8	-91.8	0.40 (1)	3.30	O-E	-1004	0	0.12 (1)
U-E	-12119	0	-91.8	-91.8	0.40 (1)	3.30	O-G	-46	33	0.02 (1)
E-V	-12119	0	-91.8	-91.8	0.45 (1)	3.23	M-H	-826	0	0.10 (1)
V-F	-12119	0	-91.8	-91.8	0.45 (1)	3.23	M-H	0	5932	0.72 (1)
F-W	-12119	0	-91.8	-91.8	0.45 (1)	3.23	L-H	0	57	0.01 (1)
W-X	-12119	0	-91.8	-91.8	0.45 (1)	3.23	B-R	0	6014	0.74 (1)
X-G	-12119	0	-91.8	-91.8	0.45 (1)	3.23	L-I	0	7274	0.90 (1)
G-H	-12159	0	-91.8	-91.8	0.39 (1)	3.30				
H-I	-8042	0	-91.8	-91.8	0.81 (1)	2.95				
I-J	0	28	-91.8	-91.8	0.07 (1)	10.00				
S-B	-4141	0	0.0	0.0	0.15 (1)	7.00				
K-I	-4926	0	0.0	0.0	0.17 (1)	6.55				
S-R	0	0	-18.5	-18.5	0.05 (1)	10.00				
R-Y	0	5974	-18.5	-18.5	0.44 (1)	10.00				
Y-Q	0	5974	-18.5	-18.5	0.44 (1)	10.00				
Q-P	0	10734	-18.5	-18.5	0.54 (1)	10.00				
P-Z	0	10734	-18.5	-18.5	0.54 (1)	10.00				
Z-O	0	10734	-18.5	-18.5	0.54 (1)	10.00				
O-AA	0	12159	-18.5	-18.5	0.71 (1)	10.00				
AA-AB	0	12159	-18.5	-18.5	0.71 (1)	10.00				
AB-N	0	12159	-18.5	-18.5	0.71 (1)	10.00				
N-AC	0	12159	-18.5	-18.5	0.71 (1)	10.00				
AC-M	0	12159	-18.5	-18.5	0.71 (1)	10.00				
M-AD	0	7208	-18.5	-18.5	0.69 (1)	10.00				
AD-AE	0	7208	-18.5	-18.5	0.69 (1)	10.00				
AE-AF	0	7208	-18.5	-18.5	0.69 (1)	10.00				
AF-L	0	7208	-18.5	-18.5	0.69 (1)	10.00				
L-AG	0	0	-18.5	-18.5	0.16 (1)	10.00				
AG-AH	0	0	-18.5	-18.5	0.16 (1)	10.00				
AH-AI	0	0	-18.5	-18.5	0.16 (1)	10.00				
AI-K	0	0	-18.5	-18.5	0.16 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)	LOC.	LOC.	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
JT	11-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
D	17-7-0	-110	-110	---	BACK	VERT	TOTAL	---	C1
E	17-7-0	-28	-28	---	BACK	VERT	TOTAL	---	C1
O	13-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN.C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.32")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/718 (0.59")

CS1 TC=0.81 1.00 (H-I), BC=0.71 1.00 (M-O), WB=0.90 1.00 (L-I), SS1=0.64 1.00 (L-M)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLJ)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (R) (INPUT = 0.90)
JSI METAL = 0.93 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007661

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T40Z	1	2	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 8 Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:19:59 2020 Page 2

ID:DMCubINVR6TsF0e31v6L_zns1l-x2qeJGB0aF2mnbcaNm9BWHyQ8EpcQa1mZAkzME7l

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	12.0	1.00	5.50
C	TTWW+m	MT20	7.0	8.0	Edge	
D	TMWW-l	MT20	5.0	6.0		
E	TMW+w	MT20	3.0	6.0		
F	TS-l	MT20	5.0	6.0		
G	TMWW-l	MT20	5.0	6.0		
H	TTWW+m	MT20	7.0	8.0	Edge	
I	TMVW-p	MT20	4.0	12.0	1.00	5.50
K	BMV1+p	MT20	3.0	5.0		
L	BMWW-l	MT20	5.0	8.0	2.50	3.00
M	BMWW-l	MT20	5.0	8.0	2.50	3.25
N	BS-l	MT20	6.0	9.0		
O	BMWWW-l	MT20	5.0	8.0		
P	BS-l	MT20	6.0	9.0		
Q	BMWW-l	MT20	5.0	8.0	2.50	3.25
R	BMWW-l	MT20	5.0	8.0	2.50	3.00
S	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
Q	11-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
T	13-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	15-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	18-8-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	20-8-4	-159	-159	---	BACK	VERT	TOTAL	---	C1
X	22-8-4	-159	-159	---	BACK	VERT	TOTAL	---	C1
Y	10-7-3	-1171	-1171	---	BACK	VERT	TOTAL	---	C1
Z	15-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AA	18-8-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AB	20-8-4	-32	-32	---	BACK	VERT	TOTAL	---	C1
AC	22-8-4	-32	-32	---	BACK	VERT	TOTAL	---	C1
AD	24-7-8	-2237	-2237	---	BACK	VERT	TOTAL	---	C1
AE	28-6-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AF	28-6-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AG	30-6-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AH	32-6-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AI	33-5-4	-121	-121	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


11 C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007661 7/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T41	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:19:59 2020 Page 1			
		ID:DMCubINVR6Tstfoa31v6I zns11-PFOOWcCOLZAIQtoAHu7hO3QDMnRzl7PphW7IAzME7k			

1-3-8 0-0 4-0-8 4-0-8 3-10-0 7-10-8 8-8-1 14-4-9 6-4-13 20-9-7 6-4-13 27-3-8 3-10-0 31-1-8 4-0-8 35-2-0 38-5-8
 1-3-8 0-0 4-0-8 4-0-8 3-10-0 7-10-8 8-8-1 14-4-9 6-4-13 20-9-7 6-4-13 27-3-8 3-10-0 31-1-8 4-0-8 35-2-0 38-5-8
 Scale = 1:57.6

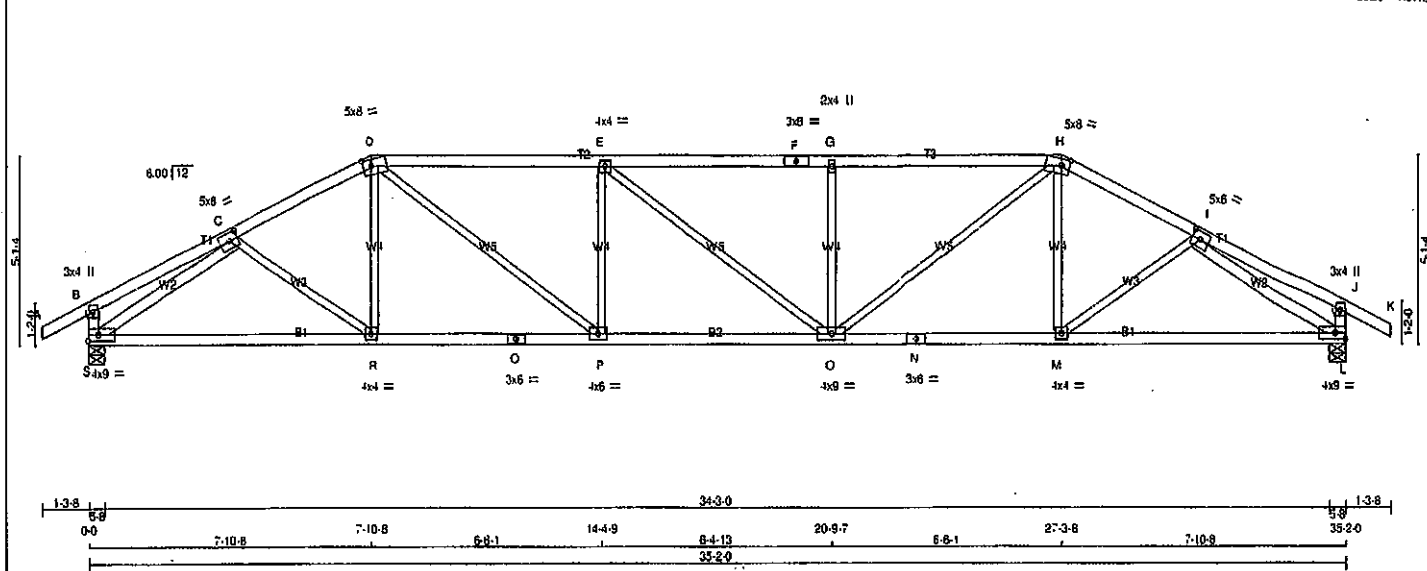

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
O - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
C	TMWW-i	MT20	5.0	6.0 2.50 2.75
D	TTWW-m	MT20	5.0	8.0 2.25 2.75
E	TMWW-i	MT20	4.0	4.0
F	TS-i	MT20	3.0	8.0
G	TMWW-w	MT20	2.0	4.0
H	TTWW-m	MT20	5.0	8.0 2.25 2.75
I	TMWW-i	MT20	5.0	8.0 2.50 2.75
J	TMV+p	MT20	3.0	4.0
L	BMVW-i	MT20	4.0	9.0 Edge
M	BMVW-i	MT20	4.0	4.0
N	BS-i	MT20	3.0	6.0
O	BMVW-w	MT20	4.0	9.0
P	BMVW-i	MT20	4.0	6.0
Q	BS-i	MT20	3.0	6.0
R	BMVW-i	MT20	4.0	4.0
S	BMVW-i	MT20	4.0	9.0 Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
S	2063	0	2063	0	5-8
L	2063	0	2063	0	5-8

UNFACTORED REACTIONS		1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE PERM.LIVE WIND DEAD SOIL
S	1457	989	0 0 0 0 0 0 0 0
L	1457	989	0 0 0 0 0 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 2.94 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERY. LOAD (PLF)	LC1 MAX. MAX. UNBRAC	MEMB.	FORCE (LBS)
FR-TO		FROM TO	CS1 (LC)	FR-TO	
A-B	0 28	-91.8 -91.8 0.12 (1)	10.00	C-R	0 93
B-C	0 16	-91.8 -91.8 0.20 (1)	10.00	D-P	0 121
C-D	-2799 0	-91.8 -91.8 0.32 (1)	3.88	D-P	0 126
D-E	-3508 0	-91.8 -91.8 0.95 (1)	2.94	E-H	-643 0
E-F	-3507 0	-91.8 -91.8 0.93 (1)	2.94	E-H	-643 0
F-G	-3507 0	-91.8 -91.8 0.93 (1)	2.94	G-H	-643 0
G-H	-3507 0	-91.8 -91.8 0.94 (1)	2.95	H-I	0 128
H-I	-2799 0	-91.8 -91.8 0.32 (1)	3.88	I-L	0 121
I-J	0 16	-91.8 -91.8 0.20 (1)	10.00	M-I	0 93
J-K	0 28	-91.8 -91.8 0.12 (1)	10.00	S-C	-2974 0
S-B	-270 0	0.0 0.0 0.03 (1)	7.81	I-L	-2974 0
L-J	-270 0	0.0 0.0 0.03 (1)	7.81		
S-R	0 2417	-18.5 -18.5 0.53 (1)	10.00		
R-O	0 2489	-18.5 -18.5 0.54 (1)	10.00		
Q-P	0 2489	-18.5 -18.5 0.54 (1)	10.00		
P-O	0 3509	-18.5 -18.5 0.64 (1)	10.00		
O-N	0 2489	-18.5 -18.5 0.54 (1)	10.00		
N-M	0 2489	-18.5 -18.5 0.54 (1)	10.00		
M-L	0 2417	-18.5 -18.5 0.53 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/CIG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 PART 9 OF CBC 2018, OBC 2012, ABC 2019
 PART 9 OF OBC 2012 (2019 AMENDMENT)
 CSA 086-09, CSA 086-14
 TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
 CALCULATED VERT. DEFL.(LL) = L/999 (0.21')
 ALLOWABLE DEFL.(LL) = L/360 (1.17')
 CALCULATED VERT. DEFL.(LL) = L/999 (0.41')

CS1: TO=0.95/1.00 (D-E:1), BC=0.64/1.00 (O-P:1), WB=0.83/1.00 (I-L:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 .354 1887 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (I) (INPUT = 0.90)
 JSI METAL = 0.77 (N) (INPUT = 1.00)



Structural component only
 DWG# T-2007682


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T42	2	1	GREEN PARK HOMES	
TAMARACK ROOF TRUSS, BURLINGTON				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:20:01 2020 Page 1

ID:DMCubINVR6TslFoe31v6l_zns11-LdWnxHegAOPgFSAHixTmP8IJ9V7RFJIG7?En3zME7I

1-3.8 0.0 5-0.8 5-0.8 4-10.0 3-10.8 7-9.8 17-7.0 25-3.8 30-1.8 35-2.0 38.5-8 1-3.8
Scale = 1:57.6

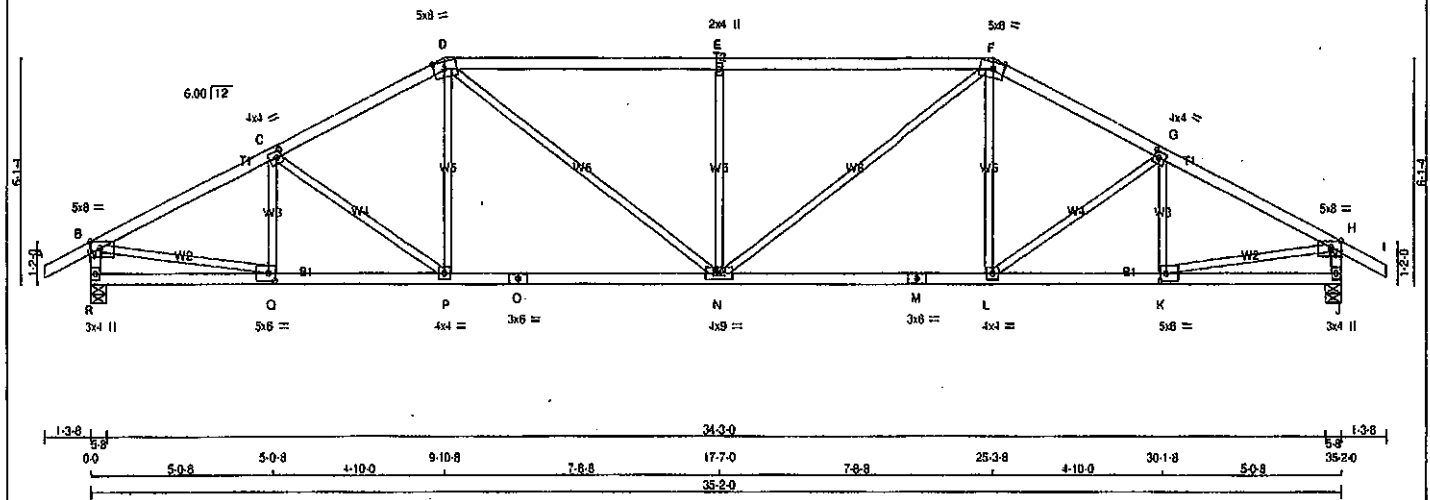

TOTAL WEIGHT = 2 X 139 = 277 lb
(M/F)

LUMBER	N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
R - B	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
R - O	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
DRY: SEASONED LUMBER.					

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TMWW-t	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	8.0	2.25	3.75
E	TMW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	8.0	2.25	3.75
G	TMWW-t	MT20	4.0	4.0	2.00	1.75
H	TMVW-p	MT20	5.0	8.0	Edge	3.50
J	BMV1-p	MT20	3.0	4.0		
K	BMWW-t	MT20	5.0	8.0	2.50	2.00
L	BMWW-t	MT20	4.0	4.0		
M	BS-t	MT20	3.0	8.0		
N	BMWW-t	MT20	4.0	4.0		
O	BS-t	MT20	3.0	8.0		
P	BMWW-t	MT20	4.0	4.0		
Q	BMWW-t	MT20	5.0	8.0	2.50	2.00
R	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
R	2063	0	2063	0
J	2063	0	2063	0

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1457	989	0	0	0	488	0
J	1457	989	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.78 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 MAX (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 28	-91.8 -91.8 0.12 (1)	Q-C	-353 0
B-C	-2634 0	-91.8 -91.8 0.39 (1)	C-P	-210 0
C-D	-2687 0	-91.8 -91.8 0.37 (1)	P-D	0 246
D-E	-3080 0	-91.8 -91.8 0.97 (1)	D-N	0 844
E-F	-3080 0	-91.8 -91.8 0.97 (1)	N-E	-872 0
F-G	-2687 0	-91.8 -91.8 0.37 (1)	N-F	0 844
G-H	-2634 0	-91.8 -91.8 0.39 (1)	H-F	0 246
H-I	0 28	-91.8 -91.8 0.12 (1)	L-G	-210 0
I-B	-2018 0	0.0 0.0 0.20 (1)	K-G	-353 0
J-H	-2018 0	0.0 0.0 0.20 (1)	B-Q	0 2591
			K-H	0 2591
R-O	0 0	-18.5 -18.5 0.10 (4)		
O-P	0 2555	-18.5 -18.5 0.51 (1)		
P-Q	0 2386	-18.5 -18.5 0.49 (1)		
Q-N	0 2386	-18.5 -18.5 0.49 (1)		
N-M	0 2386	-18.5 -18.5 0.49 (1)		
M-L	0 2386	-18.5 -18.5 0.49 (1)		
L-K	0 2555	-18.5 -18.5 0.51 (1)		
K-J	0 0	-18.5 -18.5 0.10 (4)		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = L/999 (0.17)
ALLOWABLE DEFL.(TL) = L/360 (1.17)
CALCULATED VERT. DEFL.(TL) = L/999 (0.34)

CSI: TC=0.97 1.00 (D-E:1) , BC=0.51 1.00 (P-Q:1) ,
WB=0.59 1.00 (B-Q:1) , SSI=0.34 1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PU)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (F) (INPUT = 0.90)
JSI METAL= 0.75 (M) (INPUT = 1.00)




Structural component only
DWG# T-2007663

JOB NAME 408224	TRUSS NAME T43	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRAWG NO.
Tangrak Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:20:02 2020 Page 1 ID:DMCubINVR6TstFoe31v6l_zns11-qo498dElsUYGHO1NrQSIJ1h7BZrVAiQsVknJVzME7h		

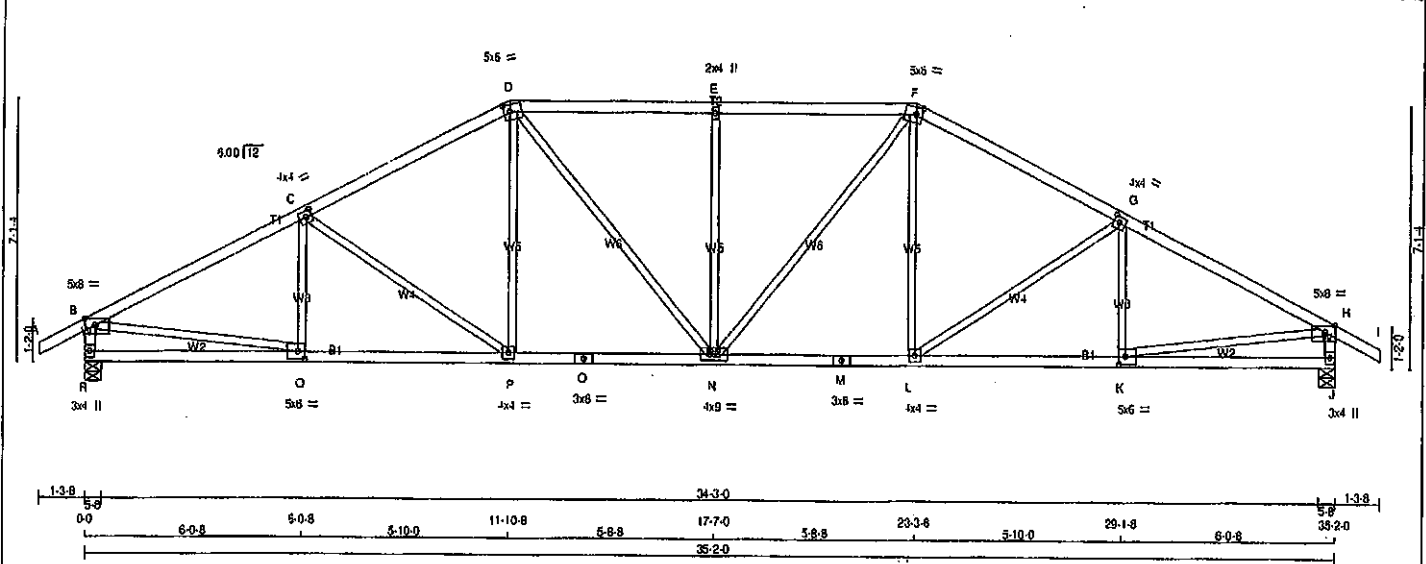


LU MBER N. L. G. A. RULES CHORDS SIZE DRY LUMBER DESCR. A - D 2x4 DRY No.2 SPF D - F 2x4 DRY No.2 SPF F - I 2x4 DRY No.2 SPF R - B 2x4 DRY No.2 SPF J - H 2x4 DRY No.2 SPF R - O 2x4 DRY No.2 SPF O - M 2x4 DRY No.2 SPF M - J 2x4 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT DRY: SEASONED LUMBER.				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. OC LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2018, OBC 2012, ABC 2019 - PART 9 OF OBC 2012 (2019 AMENDMENT) - CSA 086-09, CSA 086-14 - TPC 2011, TPC 2014 55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL. (LL) = L/360 (1.17") CALCULATED VERT. DEFL. (LL) = L. 999 (0.15") ALLOWABLE DEFL. (TL) = L/360 (1.17") CALCULATED VERT. DEFL. (TL) = L. 999 (0.28") CSI: TO=0.58/1.00 (G-H:1), BC=0.49/1.00 (K-L:1), WB=0.59/1.00 (H-K:1), SS=0.25/1.00 (D-E:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 1.00 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1887 758 1987 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.89 (Q) (INPUT = 0.90) JSI METAL= 0.89 (M) (INPUT = 1.00)			
PLATES (table is in inches) JT TYPE PLATES W LEN Y X B TMWW-p MT20 5.0 8.0 Edge 3.50 C TMWW-l MT20 4.0 4.0 2.00 1.75 D TTWW-m MT20 5.0 8.0 2.25 2.00 E TMWW-w MT20 2.0 4.0 F TTWW-m MT20 5.0 8.0 2.25 2.00 G TMWW-l MT20 4.0 4.0 2.00 1.75 H TMWW-p MT20 5.0 8.0 Edge 3.50 J BMV-l-p MT20 3.0 4.0 K BMWW-l MT20 5.0 8.0 2.50 2.25 L BMWW-l MT20 4.0 4.0 M BS-l MT20 3.0 6.0 N BMWW-l MT20 4.0 9.0 O BS-l MT20 3.0 6.0 P BMWW-l MT20 4.0 4.0 Q BMWW-l MT20 5.0 8.0 2.50 2.25 R BMV-l-p MT20 3.0 4.0 Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.				BEARINGS FACTORED MAXIMUM FACTORED INPUT RECD GROSS REACTION GROSS REACTION BRG BRG JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX R 2063 0 2063 0 0 5-8 5-8 J 2063 0 2063 0 0 5-8 5-8 UNFACTORED REACTIONS 1ST CASE MAX. MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL R 1457 969 0 0 0 0 0 488 0 0 0 J 1457 969 0 0 0 0 0 488 0 0 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS MAX. FACTORED FORCE VERT. LOAD LC1 MAX. MAX. UNBRACED LENGTH FR-TO MEMB. (LBS) (PLF) (LC) (LC) (LBS) (LC) FR-TO FROM TO A-B 0 28 -91.8 -91.8 0.12 (1) 10.00 Q-C -255 12 0.07 (1) B-C -2689 0 -91.8 -91.8 0.58 (1) 3.58 C-P -435 0 0.42 (1) C-D -2539 0 -91.8 -91.8 0.52 (1) 3.83 P-D 0 350 0.08 (1) D-E -2559 0 -91.8 -91.8 0.48 (1) 3.85 D-N 0 482 0.11 (1) E-F -2559 0 -91.8 -91.8 0.48 (1) 3.85 N-E -541 0 0.56 (1) F-G -2539 0 -91.8 -91.8 0.52 (1) 3.83 N-F 0 482 0.11 (1) G-H -2689 0 -91.8 -91.8 0.58 (1) 3.58 L-F 0 350 0.08 (1) H-I 0 28 -91.8 -91.8 0.12 (1) 10.00 L-G -435 0 0.42 (1) R-B -2014 0 0.0 0.0 0.20 (1) 5.95 K-G -255 12 0.07 (1) J-H -2014 0 0.0 0.0 0.20 (1) 5.95 B-Q 0 2635 0.59 (1) R-Q 0 0 -18.5 -18.5 0.15 (4) 10.00 K-H 0 2635 0.59 (1) Q-P 0 2609 -18.5 -18.5 0.49 (1) 10.00 P-O 0 2249 -18.5 -18.5 0.43 (1) 10.00 O-N 0 2249 -18.5 -18.5 0.43 (1) 10.00 N-M 0 2249 -18.5 -18.5 0.43 (1) 10.00 M-L 0 2249 -18.5 -18.5 0.43 (1) 10.00 L-K 0 2609 -18.5 -18.5 0.49 (1) 10.00 K-J 0 0 -18.5 -18.5 0.15 (4) 10.00			

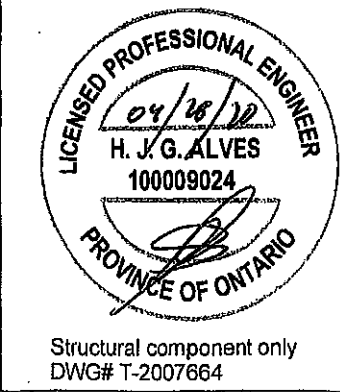

Structural component only
DWG# T-2007664

JOB NAME 408224	TRUSS NAME T44	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Farmack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 10:20:03 2020 Page 1
 ID:DMCubINVR6TstFoe31v6l zns1H0dXMzFwOog7vYcZP7xsEE72zACv9c7kJKKxzME7g
 35-20 30-5-8 1-3-8
 Scale = 1:50.0

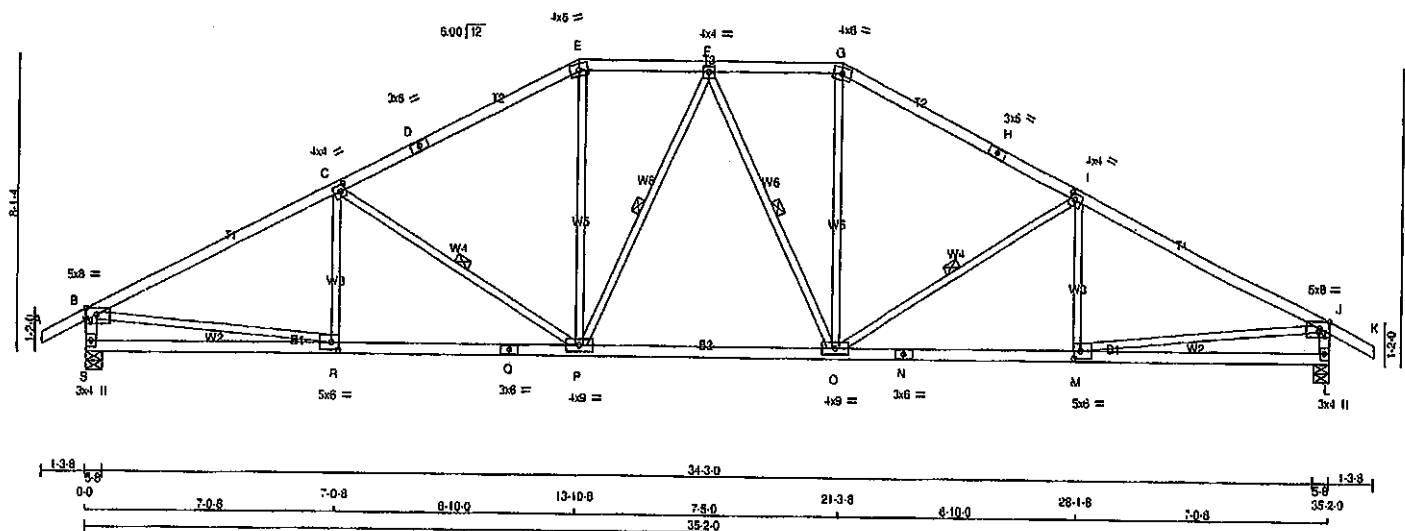

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
K - J	2x4	DRY	No.2
J - I	2x4	DRY	No.2
I - O	2x4	DRY	No.2
O - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY, SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	8.0	Edge 3.50
C	TMVW-l	MT20	4.0	4.0	2.00 1.75
D	TS-l	MT20	3.0	6.0	
E	TTW-m	MT20	4.0	6.0	
F	TMVW-l	MT20	4.0	4.0	
G	TTW-m	MT20	4.0	6.0	
H	TS-l	MT20	3.0	6.0	
I	TMVW-l	MT20	4.0	4.0	2.00 1.75
J	TMVW-p	MT20	5.0	8.0	Edge 3.60
L	BMV-l	MT20	3.0	4.0	
M	BMVW-l	MT20	5.0	6.0	2.50 2.25
N	BS-l	MT20	3.0	6.0	
O	BMVW-l	MT20	4.0	9.0	
P	BMVW-l	MT20	4.0	9.0	
Q	BS-l	MT20	3.0	6.0	
R	BMVW-l	MT20	5.0	6.0	2.50 2.25
S	BMV-l	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	HORZ	UPLIFT
S 2083 0	2083 0	0 0	5-8 5-8
L 2083 0	2083 0	0 0	5-8 5-8

UNFACTORED REACTIONS						
1ST CASE	MAX.	MIN.	COMPONENT	REACTIONS		
JT COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S 1457 889 0	0 0	0 0	0 0	0 0	488 0	0 0
L 1457 889 0	0 0	0 0	0 0	0 0	488 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-P, F-P, F-O, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
FR-TO			
A-B	0 28	-91.8 -91.8 0.12 (1)	10.00
B-C	-2906 0	-91.8 -91.8 0.83 (1)	3.25
C-D	-2373 0	-91.8 -91.8 0.72 (1)	3.66
D-E	-2373 0	-91.8 -91.8 0.72 (1)	3.66
E-F	-2100 0	-91.8 -91.8 0.19 (1)	4.53
F-G	-2100 0	-91.8 -91.8 0.19 (1)	4.53
G-H	-2373 0	-91.8 -91.8 0.72 (1)	3.66
H-I	-2373 0	-91.8 -91.8 0.72 (1)	3.66
I-J	-2906 0	-91.8 -91.8 0.83 (1)	3.25
J-K	0 28	-91.8 -91.8 0.12 (1)	10.00
S-B	-2008 0	0.0 0.0 0.20 (1)	5.98
L-J	-2008 0	0.0 0.0 0.20 (1)	5.98
S-R	0 0	-18.5 -18.5 0.20 (4)	10.00
R-Q	0 2630	-18.5 -18.5 0.52 (1)	10.00
Q-P	0 2630	-18.5 -18.5 0.52 (1)	10.00
P-O	0 2193	-18.5 -18.5 0.45 (1)	10.00
O-N	0 2630	-18.5 -18.5 0.52 (1)	10.00
N-M	0 2630	-18.5 -18.5 0.52 (1)	10.00
M-L	0 0	-18.5 -18.5 0.20 (4)	10.00

TOTAL WEIGHT = 2 X 145 = 291 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CSI: TC=0.83/1.00 (W-1), BC=0.52/1.00 (MO-1), WB=0.60/1.00 (J-M-1), SS=0.28/1.00 (B-C-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (M) (INPUT = 0.80)
JSI METAL= 0.79 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007665

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Apr 28 10:20:04 2020 Page 1



DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	8.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 4

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018 , OBC 2012 , ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 08B-14
- TPIC 2011 , TPIC 2014

15% Q OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEFL.(LL) = L 360 (1.17")
CALCULATED VERT. DEFL.(LL) = L 999 (0.14")
ALLOWABLE DEFL.(TL) = L 360 (1.17")
CALCULATED VERT. DEFL.(TL) = L 999 (0.29")

CSI: TC=0.40-1.00 (J-K); , BC=0.56-1.00 (M-N); ,
WB=0.61-1.00 (O-M); , SS=0.20-1.00 (G-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT
RESPONSIBLE FOR QUALITY CONTROL IN THE
TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY) SHEAR SECTION

	(PS)	(PL)	(PL)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (F) (INPUT = 0.90)
JSI METAL = 0.89 (G) (INPUT = 1.00)



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T46	8	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:20:05 2020 Page 1
ID:DMCubINVR6tsiFoe31v6l zns11-EOlniHBwPwrsmyWY?Qx1JYonsa117BczRwqzME78
352-0 36-3-8 13.8
Scale = 1:58.2

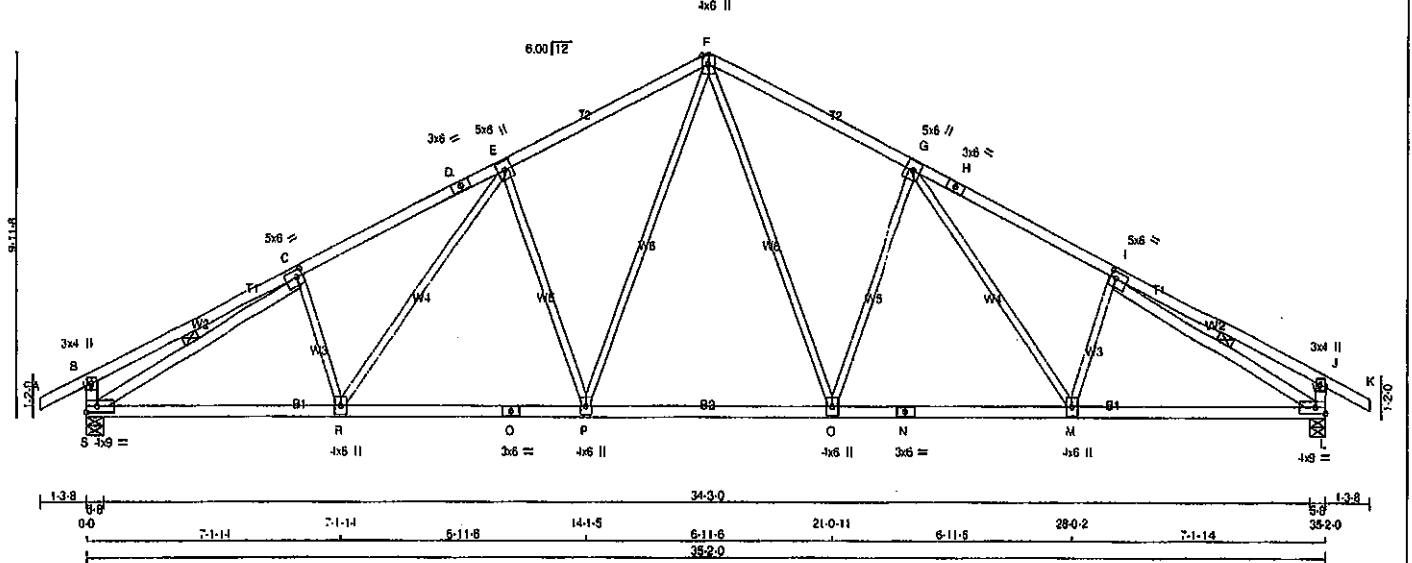

LUMBER	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES				
CHORDS				
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - K	2x4	DRY	No.2	SPF
S - B	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
S - O	2x4	DRY	No.2	SPF
Q - N	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
S - C	2x4	DRY	No.2	SPF
I - L	2x4	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE				
B TMV+p	MT20	3.0	4.0	
C TMWW+1	MT20	5.0	6.0	2.25 2.00
D TS-1	MT20	3.0	6.0	
E TMWW+1	MT20	5.0	6.0	
F TTWW+p	MT20	4.0	6.0	Edge
G TMWW+1	MT20	5.0	6.0	
H TS-1	MT20	3.0	6.0	
I TMWW+1	MT20	5.0	6.0	2.25 2.00
J TMV+p	MT20	3.0	4.0	
L BMVW+1	MT20	4.0	9.0	Edge
M, O, P, R				
M BMWW+1	MT20	4.0	8.0	
N BS-1	MT20	3.0	6.0	
Q BS-1	MT20	3.0	6.0	
S BMVW+1	MT20	4.0	9.0	Edge
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.				


DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT		REQD			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX	
S	2083	0	2083	0	0	5-8	5-8		
L	2083	0	2083	0	0	5-8	5-8		
UNFACTORED REACTIONS									
1ST CASE MAX. MIN. COMPONENT REACTIONS									
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
S	1457	969.0	0.0	0.0	0.0	488.0	0.0		
L	1457	969.0	0.0	0.0	0.0	488.0	0.0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L
BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, I-L
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. CSH (LC)	UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSH (LC)		
FR-TO		FROM TO			FR-TO				
A-B	0 28	-91.8 -91.8	0.12 (1)	10.00	F-O	0 866	0.19 (1)		
B-C	0 22	-91.8 -91.8	0.40 (1)	10.00	O-G	-728 0	0.72 (1)		
C-D	-2808 0	-91.8 -91.8	0.49 (1)	3.75	G-M	0 391	0.09 (1)		
D-E	-2808 0	-91.8 -91.8	0.49 (1)	3.75	M-I	-192 18	0.05 (1)		
E-F	-2322 0	-91.8 -91.8	0.46 (1)	4.07	P-F	0 866	0.19 (1)		
F-G	-2322 0	-91.8 -91.8	0.48 (1)	4.07	E-P	-728 0	0.72 (1)		
G-H	-2808 0	-91.8 -91.8	0.49 (1)	3.75	R-E	0 391	0.09 (1)		
H-I	-2808 0	-91.8 -91.8	0.49 (1)	3.75	C-R	-192 18	0.05 (1)		
I-J	0 22	-91.8 -91.8	0.40 (1)	10.00	S-C	-3084 0	0.72 (1)		
J-K	0 28	-91.8 -91.8	0.12 (1)	10.00	I-L	-3084 0	0.72 (1)		
S-B	-344 0	0.0 0.0	0.03 (1)	7.81					
L-J	-344 0	0.0 0.0	0.03 (1)	7.81					
S-R	0 2574	-18.5 -18.5	0.53 (1)	10.00					
R-O	0 2291	-18.5 -18.5	0.47 (1)	10.00					
O-P	0 2291	-18.5 -18.5	0.47 (1)	10.00					
P-O	0 1762	-18.5 -18.5	0.38 (1)	10.00					
O-N	0 2291	-18.5 -18.5	0.47 (1)	10.00					
N-M	0 2291	-18.5 -18.5	0.47 (1)	10.00					
M-L	0 2574	-18.5 -18.5	0.53 (1)	10.00					


DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN. C/C
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015
THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014
155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD
ALLOWABLE DEFL.(LL) = L/380 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/380 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")
CSI: TC=0.49/1.00 (C-E:1), BC=0.53/1.00 (L-M:1), WB=0.72/1.00 (E-P:1), SS=0.22/1.00 (I-J:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10
COMPANION LIVE LOAD FACTOR = 1.00
AUTOSOLVE HEELS OFF
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP = 0.87 (C) (INPUT = 0.90)
JSI METAL = 0.77 (I) (INPUT = 1.00)



Structural component only
DWG# T-2007667

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T48	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 26 10:20:07 2020 Page 1	

ID:DMCubINVR8TstF0e31v8I zns1t-At2CLIR50AZ0AvKz1u04OyjadNr3HbfwSY jzME7c
6-7-12 6-8-8 0,12 3-9-8 10-6-0
Scale = 1:18.2

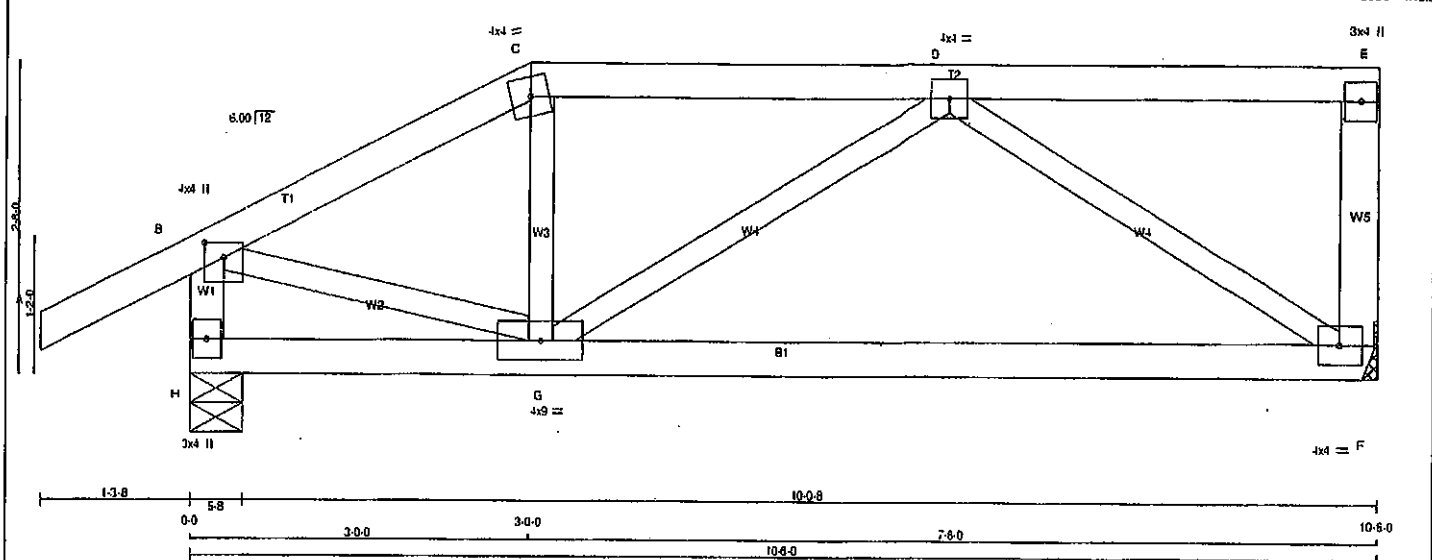

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

ORY: SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMWV+p	MT20	4.0	4.0 1.50 2.00
C	TTW+m	MT20	4.0	4.0
D	TMWV-i	MT20	4.0	4.0
E	TMW+p	MT20	3.0	4.0
F	BMWV-i	MT20	4.0	4.0
G	BMWVW-i	MT20	4.0	9.0
H	BMV+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	DOWN	UP	BRG
F	579 0	579 0	0 0	MECHANICAL	BRG
H	703 0	703 0	0 0	5-8	IN-SX

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	409	269 0	0 0	0 0	0 0	141 0	0 0
H	495	338 0	0 0	0 0	0 0	157 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	0 28	G-C	0 61
B-C	-835 0	G-D	-61 80
C-D	-569 0	D-F	-731 0
D-E	0 0	B-G	0 587
F-E	-135 0		
H-B	-699 0		
H-G	0 0		
G-F	0 819		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L. 989 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L. 989 (0.06")

CSI: TC=0.21+1.00 (C-D:1), BC=0.25+1.00 (F-G:4), WB=0.23+1.00 (D-F:1), SSI=0.17+1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PS)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	818	354	1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.68 (B) (INPUT = 0.80)
JSI METAL= 0.23 (F) (INPUT = 1.00)

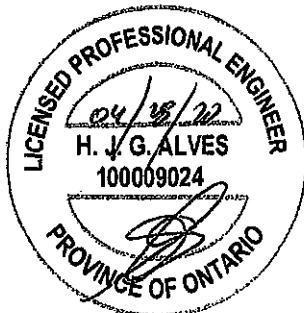


Structural component only
DWG# T-2007669

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T49	1	1	GREEN PARK HOMES	
Tamrack Roof Truss, Burlington		TRUSS DESC.			

Tamrack Roof Truss, Burlington

Version 8.310 5 Oct 2019 Mitek Industries, Inc. Tue Apr 28 10:20:08 2020 Page 1

ID:DMCubINVR6TsFoe31v8f_zns1f-ezRQPhJ3DKIQ0JUWCgZ7Zix3M_ziaUMKlaB5W9zME7b

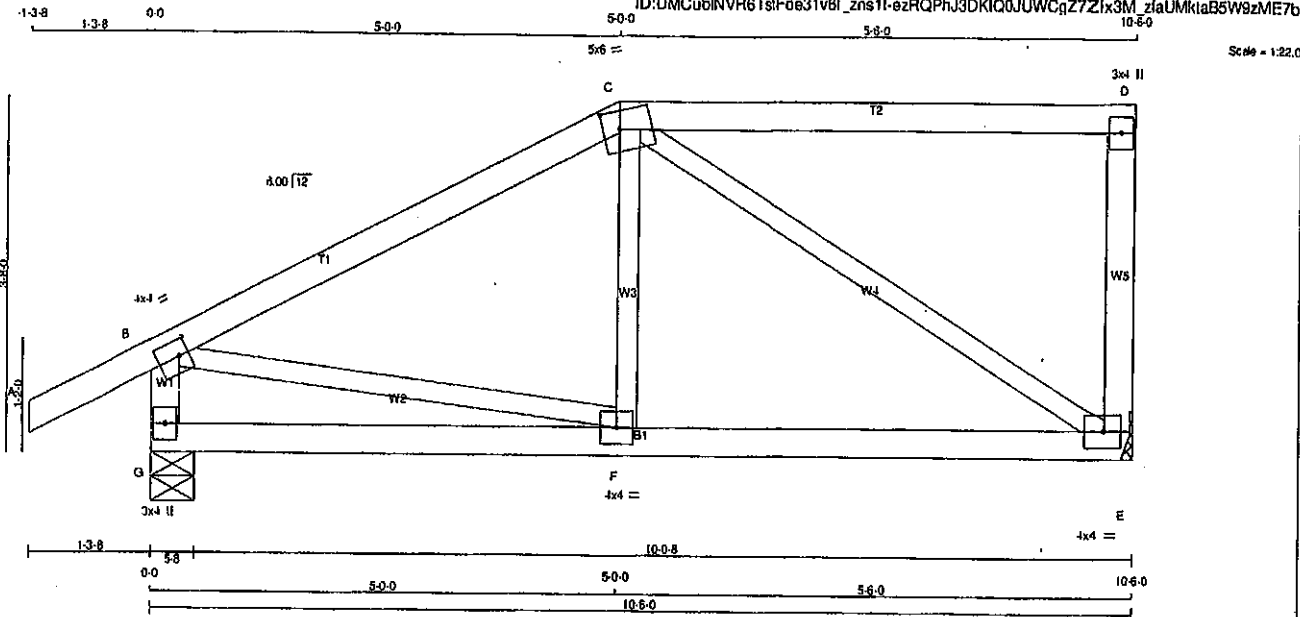

TOTAL WEIGHT = 42 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
G - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-1	MT20	4.0	4.0	2.00 1.25
C	TTWW-m	MT20	5.0	6.0	2.25 2.00
D	TMV-p	MT20	3.0	4.0	
E	BMVW-1	MT20	4.0	4.0	
F	BMVW-1	MT20	4.0	4.0	
G	BMV-1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORZ	UPLIFT
E	579	0	579	0
G	703	0	703	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	409	269 0	0 0	0 0	0 0	141 0	0 0
G	495	338 0	0 0	0 0	0 0	157 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. CS (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LBS)	
FR-TO		FROM TO		FR-TO			
A-B	0 28	-91.8 -91.8 0.12 (1)	10.00	F-C	0 106	0.04 (4)	
B-C	-523 0	-91.8 -91.8 0.41 (1)	6.25	C-E	-549 0	0.37 (1)	
C-D	0 0	-91.8 -91.8 0.47 (1)	10.00	B-F	0 474	0.11 (1)	
E-D	-252 0	0.0 0.0 0.05 (1)	7.81				
G-B	-667 0	0.0 0.0 0.07 (1)	7.81				
G-F	0 0	-18.5 -18.5 0.14 (4)	10.00				
F-E	0 468	-18.5 -18.5 0.19 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
OL = 6.0 PSF
BOT CH. LL = 0.0 PSF
OL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.35')
CALCULATED VERT. DEFL. (LL) = L/999 (0.01')
ALLOWABLE DEFL. (TL) = L/360 (0.35')
CALCULATED VERT. DEFL. (TL) = L/999 (0.03')

CSI: TC=0.47 (C-D:1), BC=0.19 (F:4),
WB=0.37 (C-E:1), SS=0.20 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
	MAX	MIN	MAX MIN
MT20	618	354	1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.85 (8) (INPUT = 0.90)
JSI METAL = 0.26 (8) (INPUT = 1.00)

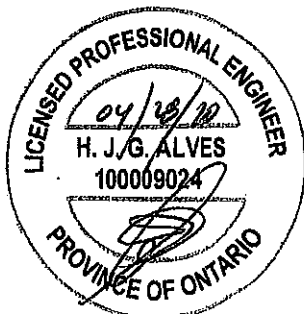

Structural component only
DWG# T-2007670

Tamarack Roof Truss, Budington

Version 3.110 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:20:10 2020 Page 1
ID:DMCubINVR6TstFoe31v6l zns1l-bMYB6MKJlxY8FdeWJ5bpeil0KcoeV2T1l unCh2zMEZZ



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY DESIGNER						
PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING						
BEARINGS						
JT	FACTORED GROSS REACTION		FACTORED GROSS REACTION		INPUT BRG	REORD BRG
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX
C	371	0	371	0	5-L	
D	371	0	371	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT C. MINIMUM BEARING LENGTH AT JOINT C = 1'-8".

UNFACTORED REACTIONS							
1ST LCASE		MAX-MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	268	143.0	0.0	0.0	0.0	125.0	0.0
C	268	143.0	0.0	0.0	0.0	125.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: 14)

CHORDS				WEBBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LCL (L)	MAX. UNBRAC. LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LCL (L)
FR-TO		FROM TO	CSI (L)	FR-TO	A-C		
D-A	-318 0	0.0	0.0 0.06 (1)	7.81			
A-B	0 0	-114.3	-114.3 0.81 (1)	10.00			
C-B	-319 0	0.0	0.0 0.06 (1)	7.81			
D-C	0 0	-18.5	-18.5 0.23 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	OL =	15.0	PSF
BOT CH.	LL =	0.0	PSF
	OL =	7.4	PSF
TOTAL LOAD	=	48.0	PSF

SPACING = 24.0 I.N. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9.
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBO 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.81/1.00 (A-B:1), BC=0.23/1.00 (C-D:4),
WB=0.00/1.00 (A-C:1), SSI=0.33/1.00 (A-B:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY) (PSI)		SHEAR (PLI)		SECTION (PU)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1867	788	1987	1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.25 (A) (INPUT = 0.80)
JSI METAL= 0.07 (A) (INPUT = 1.00)




Structural component only
DWG# T-2007671

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	G50	1	1	GREEN PARK HOMES	
Tamrack Roof Truss, Burlington		TRUSS DESC.			

Tamrack Roof Truss, Burlington

Version 3.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:19:51 2020 Page 1
ID:DMCubNVR6Tsf0e31v6l zns1f-eiv?r6OD89qTthFcl7MikFo7CC5i2EzRaiQezME7s

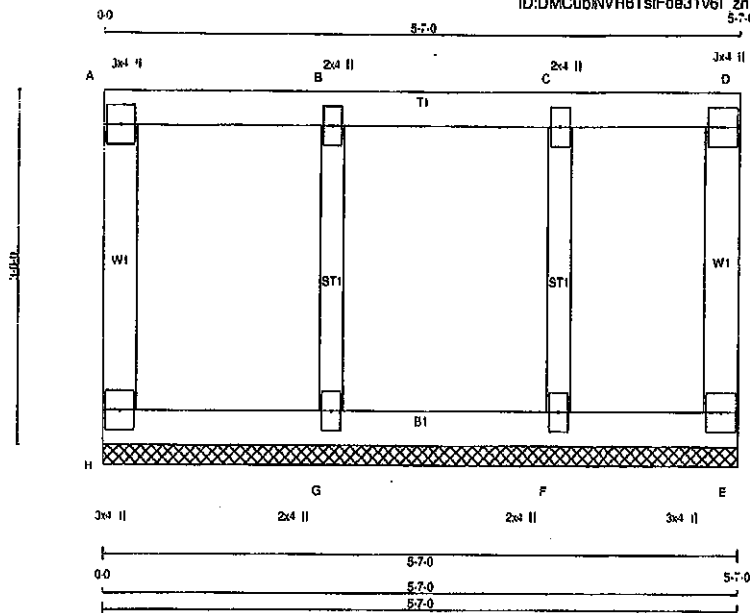

Scale = 1:18.1

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS			
H - A	2x4	DRY	No.2
A - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
H - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2'-0" O.C.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMV+p	MT20	3.0	4.0
B	TMV+w	MT20	2.0	4.0
C	TMV+w	MT20	2.0	4.0
D	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0
F	BMV1+w	MT20	2.0	4.0
G	BMV1+w	MT20	2.0	4.0
H	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING.

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED (CSI/LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED (CSI/LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
H-A	-101 0	0.0	0.0 0.03 (1)	7.81	G-B	-248 0	0.08 (1)
A-B	-8 0	-114.3	-114.3 0.08 (1)	10.00	F-C	-209 0	0.05 (1)
B-C	-8 0	-114.3	-114.3 0.08 (1)	10.00			
C-D	-8 0	-114.3	-114.3 0.08 (1)	10.00			
E-D	-80 0	0.0	0.0 0.03 (1)	7.81			
H-G	0 8	-18.5	-18.5 0.02 (4)	10.00			
G-F	0 8	-18.5	-18.5 0.02 (4)	10.00			
F-E	0 8	-18.5	-18.5 0.02 (4)	10.00			

TOTAL WEIGHT = 22 lb (M/R)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6	PSF
DL	= 15.0	PSF
BOT CH. LL	= 0.0	PSF
DL	= 7.4	PSF
TOTAL LOAD	= 48.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.08/1.00 (A-B:1), BC=0.02/1.00 (G-H:1), WB=0.03/1.00 (B-G:1), SS=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (G) INPUT = 0.90
JSI METAL= 0.07 (G) INPUT = 1.00



Structural component only
DWG# T-2007656


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	T51	1	1	TRUSS DESC.		

Tamagack Roof Truss, Burlington

Version 8.310.8 Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:20:11 2020 Page 1

ID:DMCubINVR6TslFoe31v6l_zns11-3Y6Z1ilxWfg?tnD5ip8qAwZamBzqsmAZYOI7UzME7Y


Scale = 1:20.5

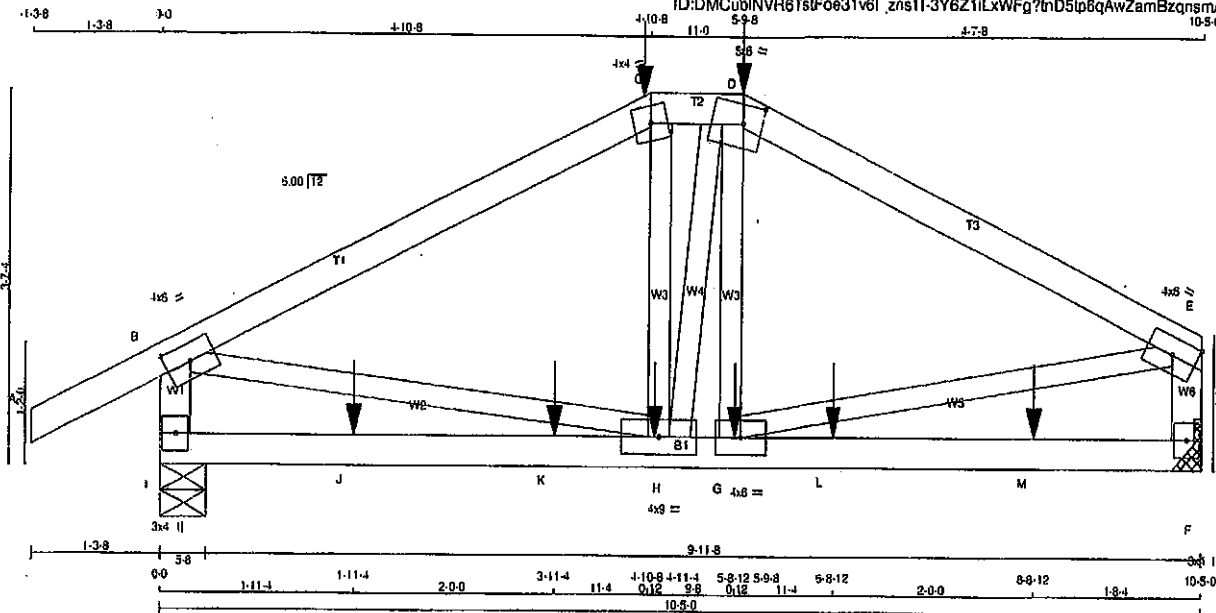

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	T52	1	1	TRUSS DESC.		

Tamrack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:20:12 2020 Page 1
ID:DMCubINVR6TsiFob3Iv6I_zns11-XlqxP2MaHZpsUxoiRWd3j88qEbM8WMqKoc9JwzME7X

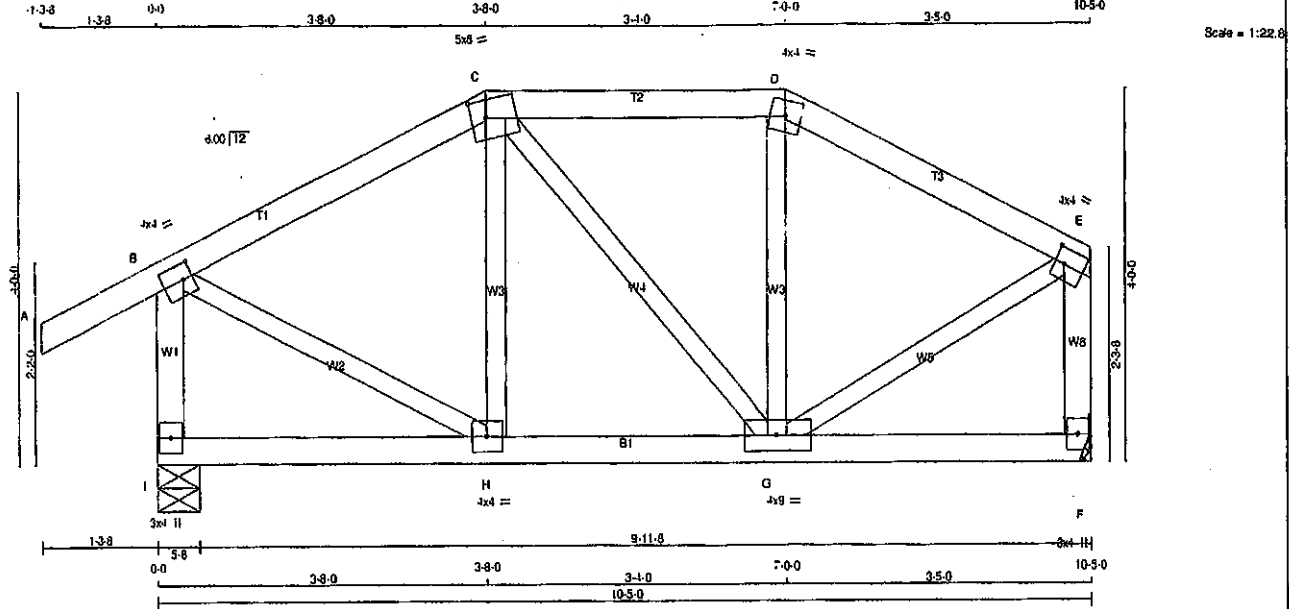

TOTAL WEIGHT = 46 lb (M)

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
G - H	2x4	DRY	No.2	SPF
H - I	2x4	DRY	No.2	SPF
I - F	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	4.0	2.00	1.25
C	TTWW-m	MT20	5.0	6.0	2.25	2.00
D	TTW-m	MT20	4.0	4.0		
E	TMVW-1	MT20	4.0	4.0	2.00	1.25
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-1	MT20	4.0	9.0		
H	BMVWW-1	MT20	4.0	4.0		
I	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECHD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UP	IN-SX
I	699	0	699	0
F	574	0	574	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1'-8".

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	492	338	0	0	0	156	0
F	406	267	0	0	0	140	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 28	-91.8 -91.8 0.12 (1)	10.00	H-C	-118 14	0.03 (1)	
B-C	-423 0	-91.8 -91.8 0.16 (1)	6.25	C-D	-20 0	0.01 (1)	
C-D	-362 0	-91.8 -91.8 0.13 (1)	6.25	G-D	-126 8	0.03 (1)	
D-E	-409 0	-91.8 -91.8 0.14 (1)	6.25	H-H	0 422	0.09 (1)	
E-F	-659 0	0 0 0.08 (1)	7.61	G-E	0 419	0.08 (1)	
F-E	-546 0	0 0 0.07 (1)	7.61				
I-H	0 0	-18.5 -18.5 0.05 (4)	10.00				
H-G	0 375	-18.5 -18.5 0.09 (1)	10.00				
G-F	0 0	-18.5 -18.5 0.05 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL = 6.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.16/1.00 (B-C:1), BC=0.09/1.00 (G-H:1), WB=0.09/1.00 (B-H:1), SS=0.12/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX	MIN	MAX
618	354	1667
788	1987	1855

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (B) (INPUT = 0.90)
JSI METAL = 0.21 (B) (INPUT = 1.00)

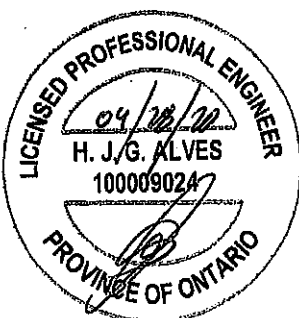


Structural component only
DWG# T-2007673

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	T53	1	1	TRUSS DESC.		

Tamrack Roof Truss, Burlington

Version 8.310 \$ Oct 28 2019 Mitak Industries, Inc. Tue Apr 28 10:20:13 2020 Page 1

ID:DMCubINVR6TsiFoe31v6l zns11-7xEJSONC2sxi65NU E8IGLezS7iHFOFT1svsCMzME7W

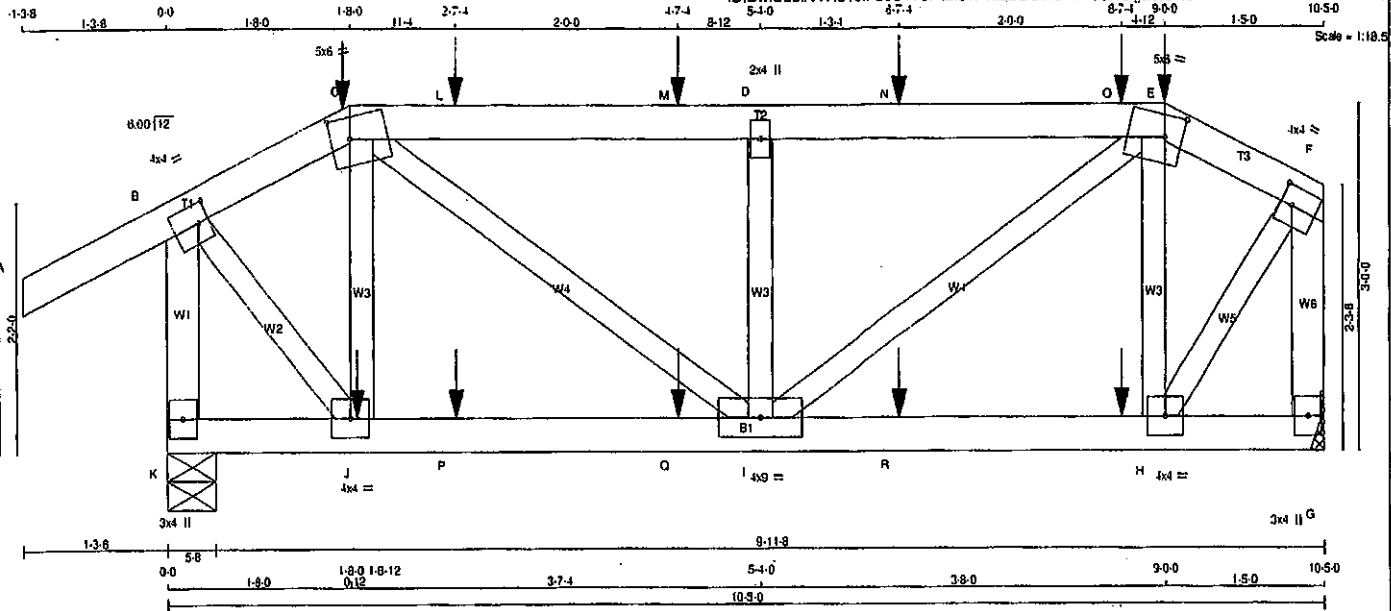

TOTAL WEIGHT = 46 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
K - B	2x4	DRY	No.2	SPF	
K - F	2x4	DRY	No.2	SPF	
K - G	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	4.0	2.00	1.25
C	TTWW-m	MT20	5.0	6.0	2.25	2.00
D	TMVW-w	MT20	2.0	4.0		
E	TTWW-m	MT20	5.0	6.0	2.25	2.00
F	TMVW-t	MT20	4.0	4.0	2.00	1.25
G	BMV1-p	MT20	3.0	4.0		
H	BMVW-t	MT20	4.0	4.0		
I	BMVWW-t	MT20	4.0	9.0		
J	BMVW-1	MT20	4.0	4.0		
K	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
K	818	0	818	0
G	679	0	679	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	576	393	0	0	0	183	0
G	480	317	0	0	0	162	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 28	-91.8	-91.8 0.13 (1)	10.00	J-C	-307 0	0.08 (1)
B-C	-427 0	-91.8	-91.8 0.13 (1)	8.25	C-I	0 438	0.11 (1)
C-L	-702 0	-91.8	-91.8 0.28 (1)	0.25	I-D	-472 0	0.09 (1)
L-M	-702 0	-91.8	-91.8 0.28 (1)	0.25	D-E	0 499	0.12 (1)
M-D	-702 0	-91.8	-91.8 0.28 (1)	0.25	H-E	-373 0	0.07 (1)
D-N	-702 0	-91.8	-91.8 0.28 (1)	0.25	B-J	0 523	0.13 (1)
N-O	-702 0	-91.8	-91.8 0.28 (1)	0.25	H-F	0 558	0.14 (1)
O-E	-702 0	-91.8	-91.8 0.28 (1)	0.25			
E-F	-379 0	-91.8	-91.8 0.04 (1)	7.81			
K-B	-812 0	0.0	0.0 0.10 (1)	7.81			
G-F	-677 0	0.0	0.0 0.09 (1)	7.81			
K-J	0 0	-18.5	-18.5 0.04 (4)	10.00			
J-P	0 349	-18.5	-18.5 0.09 (1)	10.00			
P-O	0 349	-18.5	-18.5 0.09 (1)	10.00			
Q-I	0 349	-18.5	-18.5 0.09 (1)	10.00			
I-R	0 324	-18.5	-18.5 0.09 (1)	10.00			
R-H	0 324	-18.5	-18.5 0.09 (1)	10.00			
H-G	0 0	-18.5	-18.5 0.04 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	1-8-0	-53	-53	...	BACK	VERT	TOTAL	...	C1
E	9-0-0	-21	-21	...	FRONT	VERT	TOTAL	...	C1
H	8-7-4	-4	-4	...	BACK	VERT	TOTAL	...	C1
J	1-8-12	-4	-4	...	BACK	VERT	TOTAL	...	C1
L	2-7-4	-28	-28	...	BACK	VERT	TOTAL	...	C1
M	4-7-4	-25	-25	...	BACK	VERT	TOTAL	...	C1
N	6-7-4	-25	-25	...	BACK	VERT	TOTAL	...	C1
O	8-7-4	-53	-53	...	BACK	VERT	TOTAL	...	C1
P	2-7-4	-4	-4	...	BACK	VERT	TOTAL	...	C1
Q	4-7-4	-4	-4	...	BACK	VERT	TOTAL	...	C1
R	6-7-4	-4	-4	...	BACK	VERT	TOTAL	...	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

- 55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.35")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.35")
CALCULATED VERT. DEFL. (TL) = L/999 (0.02")

CSK: TC=0.26 (1.00 @ E-I), SC=0.09 (1.00 @ J-I), WB=0.14 (1.00 @ F-H), SG=0.21 (1.00 @ C-D-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1067 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.77 (F) (INPUT = 0.90)
JSI METAL= 0.22 (F) (INPUT = 1.00)

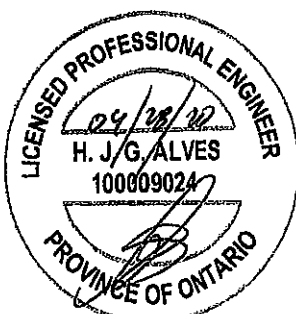

Structural component only
DWG# T-2007674

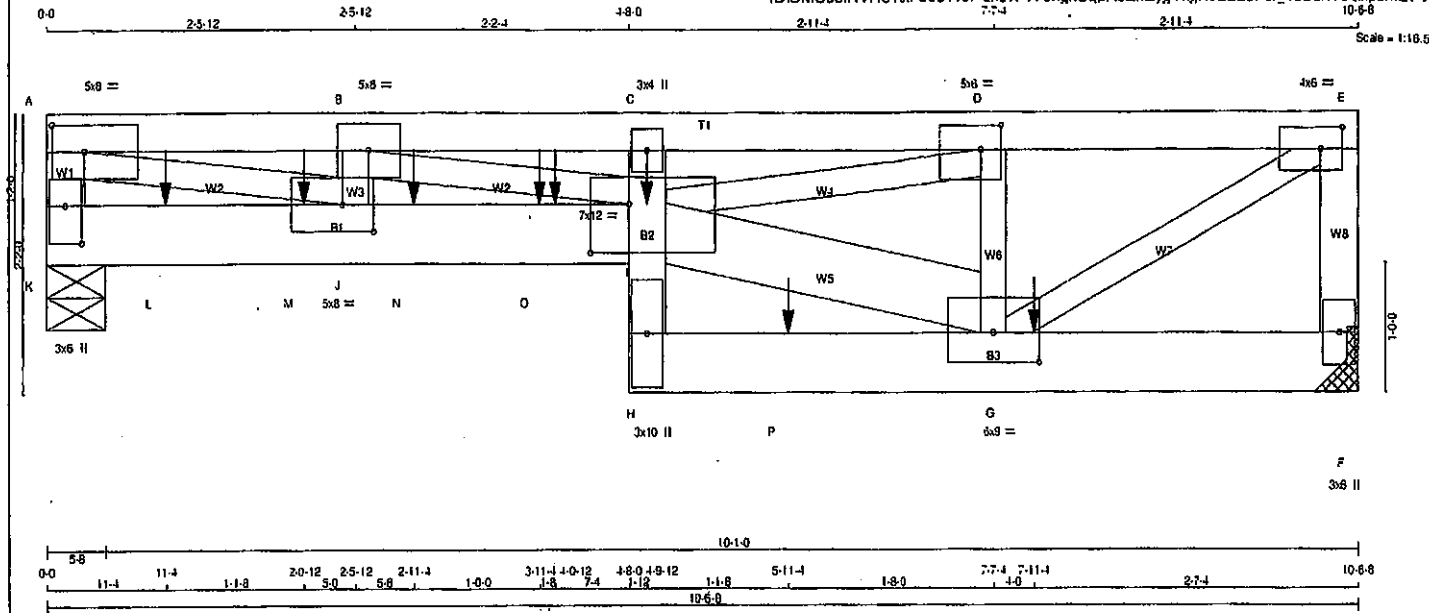

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR
K - A	2x4	DRY	No.2		SPF
A - E	2x4	DRY	No.2		SPF
F - E	2x4	DRY	No.2		SPF
K - I	2x6	DRY	No.2		SPF
H - C	2x4	DRY	No.2		SPF
H - F	2x6	DRY	No.2		SPF
ALL WEBS		2x3	DRY	No.2	SPF
EXCEPT					
I - G	2x6	DRY	No.2		SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (in)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
K-A	12	TOP
A-E	12	TOP
E-F	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
K-I	12	SIDE (81.0)
H-F	12	SIDE (183.1)
C-H	5	SIDE (89.8)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	
2x6	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	IN-SX	IN-SX
K 2604	0	2804	5-8
F 2255	0	2255	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F MINIMUM BEARING LENGTH AT JOINT F = 4-0.

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERALIVE WIND DEAD SOIL
K 1841	1212 0 0 0 0 0 0
F 1592	1061 0 0 0 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.36 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO		FR-TO			
K-A	-2274	0.0	0.0 0.13 (1)	I-G	0	2889	0.19 (1)
A-B	-6894	0	-91.8 -91.8 0.22 (1)	I-D	0	5928	0.73 (1)
B-C	-10298	0	-91.8 -91.8 0.68 (1)	G-E	-2146	0	0.17 (1)
C-D	-9247	0	-91.8 -91.8 0.61 (1)	G-E	0	4043	0.50 (1)
D-E	-3416	0	-91.8 -91.8 0.16 (1)	J-B	-1577	0	0.12 (1)
E-F	-2242	0	0.0 0.0 0.13 (1)	A-J	0	7027	0.87 (1)
				B-I	0	3805	0.47 (1)
K-L	0	0	-18.5 -18.5 0.21 (1)				
L-M	0	0	-18.5 -18.5 0.21 (1)				
M-J	0	0	-18.5 -18.5 0.21 (1)				
J-N	0	8894	-18.5 -18.5 0.79 (1)				
N-O	0	8894	-18.5 -18.5 0.79 (1)				
O-I	0	8894	-18.5 -18.5 0.79 (1)				
H-I	0	354	0.0 0.0 0.65 (1)				
I-C	0	128	0.0 0.0 0.63 (1)				
H-P	0	832	-18.5 -18.5 0.20 (1)				
P-G	0	832	-18.5 -18.5 0.20 (1)				
G-F	0	0	-18.5 -18.5 0.01 (4)				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	FACE	DIR.	TYPE	HEEL	CONN.
G	7-11-4	-861	-661	---	BACK	VERT	TOTAL	C1
I	4-9-12	-577	-577	---	FRONT	VERT	TOTAL	C1
L	11-4	-72	-72	---	BACK	VERT	TOTAL	C1
M	2-0-12	-352	-352	---	FRONT	VERT	TOTAL	C1
N	2-11-4	-142	-142	---	BACK	VERT	TOTAL	C1
O	3-11-4	-983	-983	---	BACK	VERT	TOTAL	C1
P	4-0-12	-354	-354	---	FRONT	VERT	TOTAL	C1
	5-11-4	-556	-556	---	BACK	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.35")

CALCULATED VERT. DEFL. (LL) = L/862 (0.15")

ALLOWABLE DEFL. (TL) = L/360 (0.35")

CALCULATED VERT. DEFL. (TL) = L/469 (0.27")

CSI: TC=0.66(1.00 (B-C:1)), BC=0.79(1.00 (I-J:1)), WB=0.87 (1.00 (A-J:1)), SS=0.45(1.00 (C-I:1))

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

IPSB (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (E) (INPUT = 0.80)

JSI METAL = 0.73 (D) (INPUT = 1.00)



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	T54S	1	2	TRUSS DESC.		


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:20:14 2020 Page 2


ID:DMCubINVR6TstFoe3iv6t zns11-T7ahqkOgpA3ZkEygYxqXoZB2uPsf 43dGWeQkpozME7Y


PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-I	MT20	5.0	8.0	2.50	3.00
B	TMVW-I	MT20	5.0	6.0		
C	TMV-p	MT20	3.0	4.0		
D	TMVW-I	MT20	5.0	6.0	2.25	2.00
E	TMVW-I	MT20	4.0	6.0	2.00	2.00
F	BMV1+p	MT20	3.0	8.0		
G	BMVWW-I	MT20	6.0	9.0	2.75	4.50
H	BMV-p	MT20	3.0	10.0		
I	BVMWWW-I	MT20	7.0	12.0	4.50	3.75
J	BMVW-I	MT20	5.0	8.0	2.50	3.00
K	BMV1+p	MT20	3.0	6.0	3.50	1.50

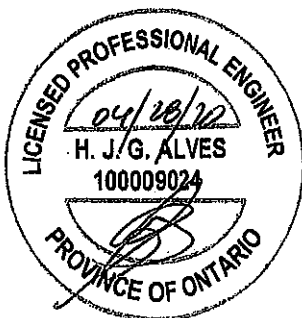

Structural component only
DWG# T-2007675

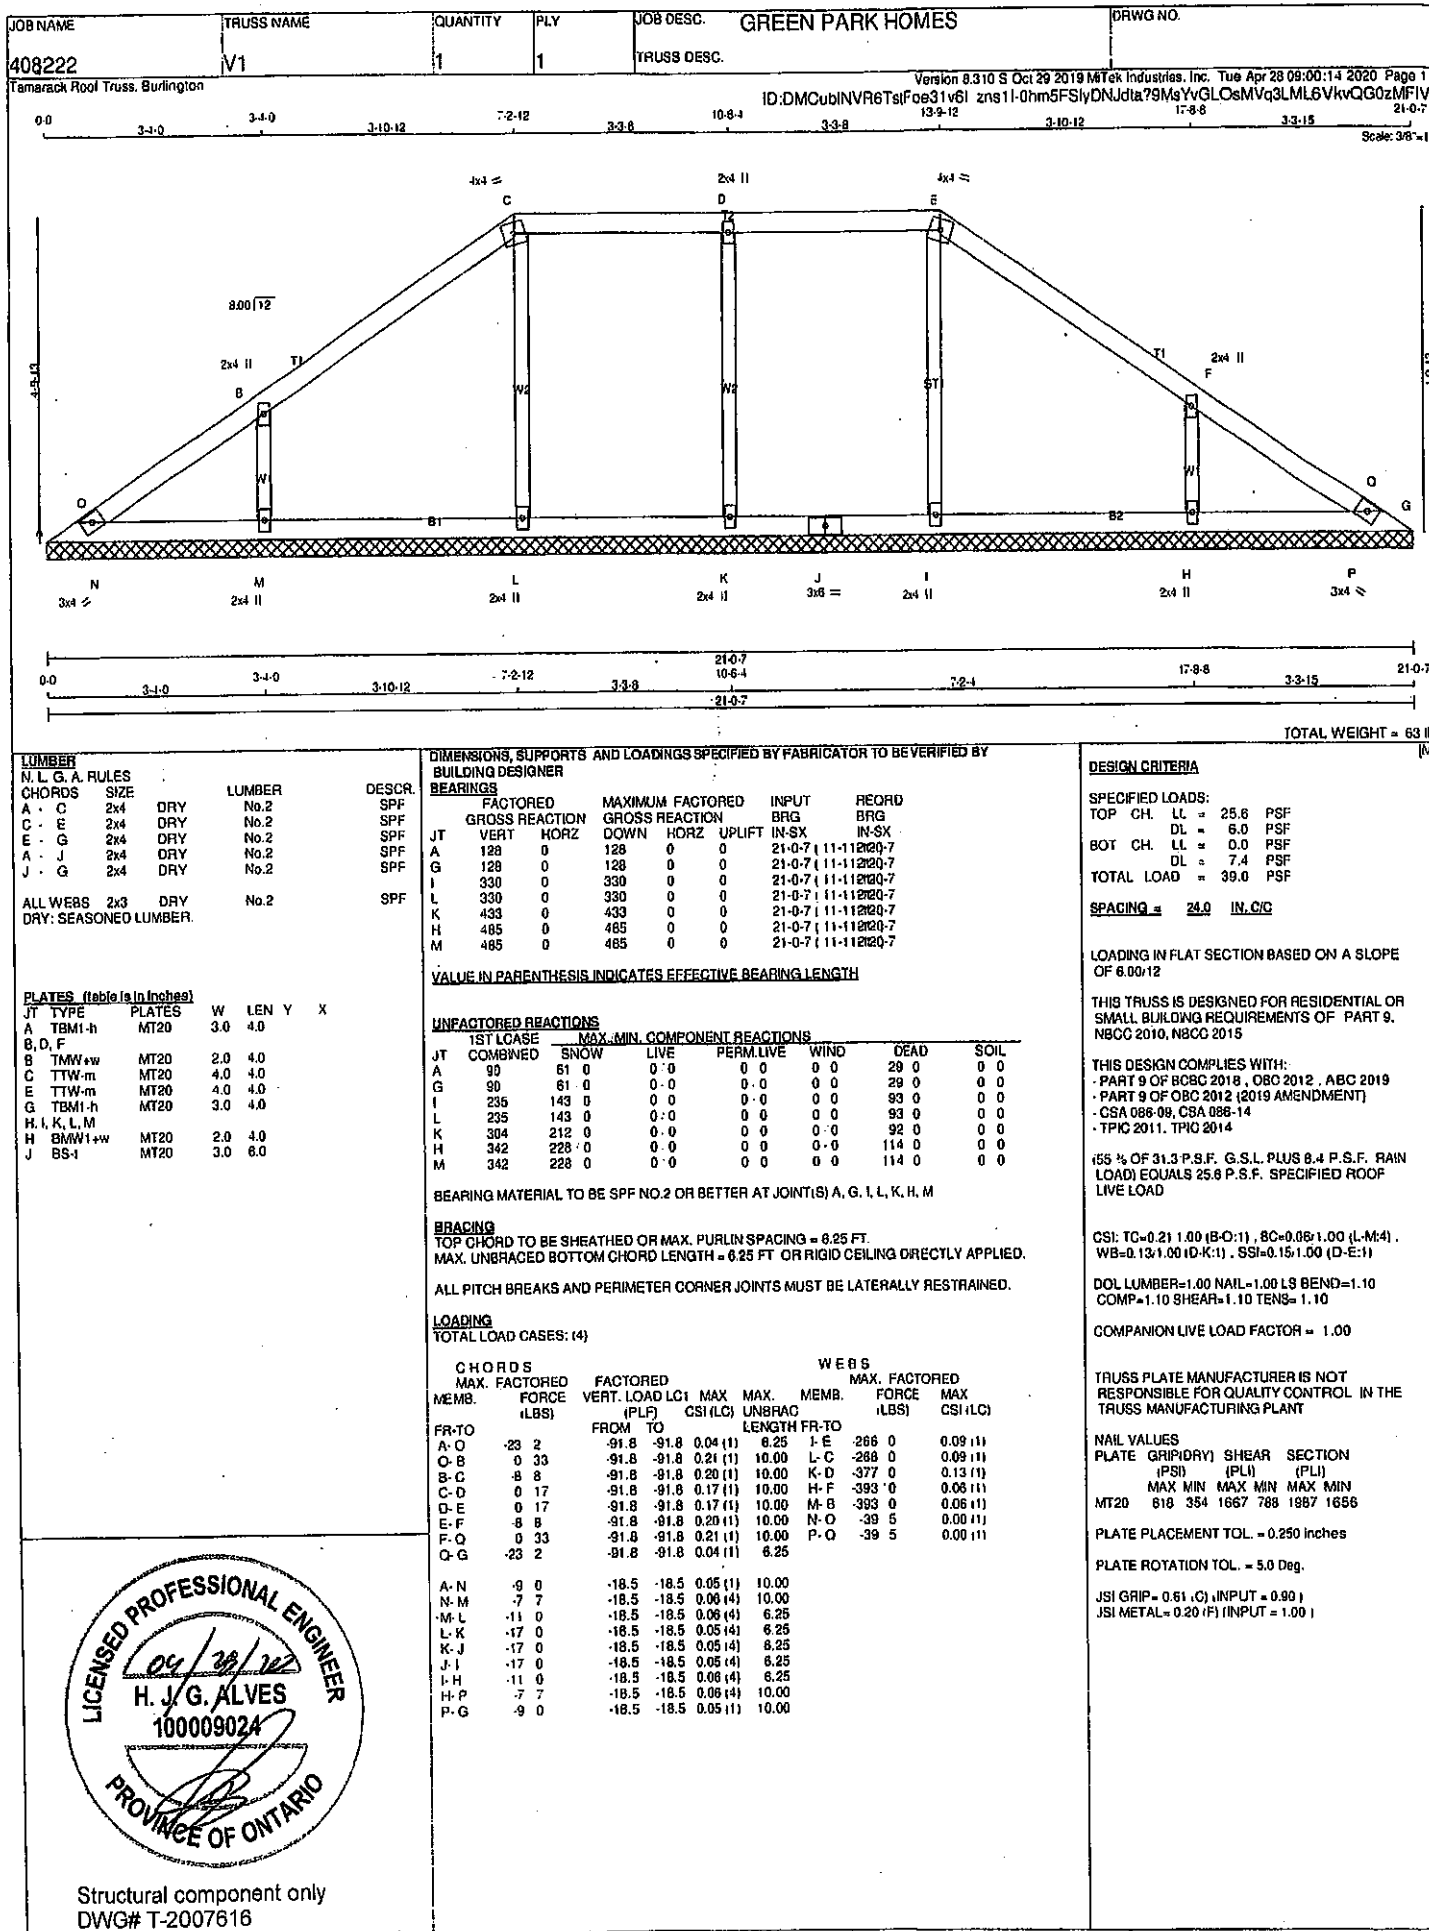

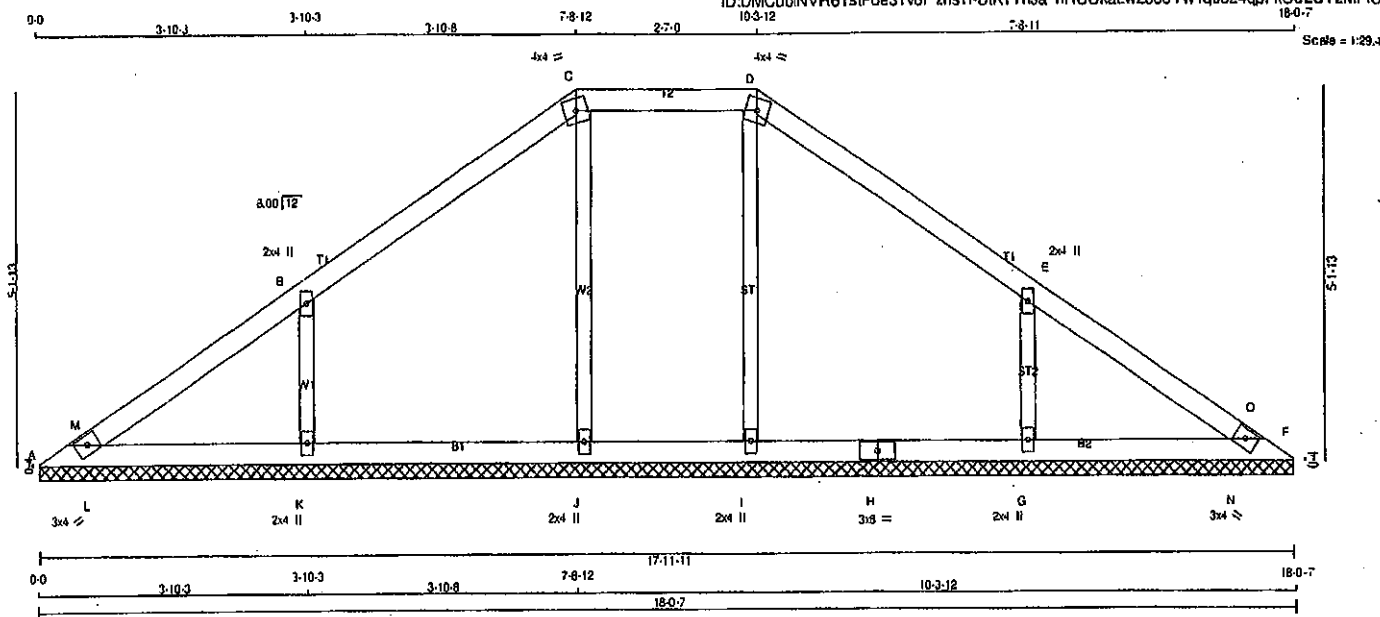

LUMBER
 N. L. G. A. RULES
 CHORDS SIZE LUMBER DESCR.
 A - C 2x4 DRY No.2 SPF
 C - D 2x4 DRY No.2 SPF
 D - F 2x4 DRY No.2 SPF
 A - H 2x4 DRY No.2 SPF
 H - F 2x4 DRY No.2 SPF
 ALL WEBS 2x3 DRY No.2 SPF
 DRY: SEASONED LUMBER.

PLATES (feet/inches)
 JT TYPE PLATES W LEN Y X
 A TBM1-h MT20 3.0 4.0
 B TMW-w MT20 2.0 4.0
 C TTW-m MT20 4.0 4.0
 D TTW-m MT20 4.0 4.0
 E TMW-w MT20 2.0 4.0
 F TBM1-h MT20 3.0 4.0
 G, I, J, K BMW1-w MT20 2.0 4.0
 H BS-l MT20 3.0 8.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	UP/LIFT		
A	138	0	138	0	17-11-11	11-17-12-1
F	135	0	135	0	17-11-11	11-17-12-1
I	344	0	344	0	17-11-11	11-17-12-1
G	513	0	513	0	17-11-11	11-17-12-1
J	342	0	342	0	17-11-11	11-17-12-1
K	513	0	513	0	17-11-11	11-17-12-1

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST LOSE COMBINED	MAX. MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	96	85	0	0	0	30	0
F	95	85	0	0	0	30	0
I	244	155	0	0	0	89	0
G	362	240	0	0	0	122	0
J	242	154	0	0	0	88	0
K	362	240	0	0	0	122	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, F, I, G, J, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT. OR RIGID CEILING DIRECTLY APPLIED.
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS			WEBS		
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC) UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)
FR-TO				FR-TO		
A-M	0 20	-91.8	-91.8 0.04 (1)	10.00	I-D	-292 0 0.11 (1)
M-B	0 71	-91.8	-91.8 0.22 (1)	10.00	G-E	-408 0 0.07 (1)
B-C	0 33	-91.8	-91.8 0.22 (1)	10.00	J-C	-291 0 0.11 (1)
C-D	0 52	-91.8	-91.8 0.11 (1)	10.00	K-B	-408 0 0.07 (1)
D-E	0 33	-91.8	-91.8 0.22 (1)	10.00	L-M	-71 4 0.00 (1)
E-O	0 71	-91.8	-91.8 0.22 (1)	10.00	N-O	-89 5 0.00 (1)
O-F	0 19	-91.8	-91.8 0.04 (1)	10.00		
A-L	-43 0	-18.5	-18.5 0.07 (1)	6.25		
L-K	-30 0	-18.5	-18.5 0.07 (1)	6.25		
K-J	-45 0	-18.5	-18.5 0.07 (4)	6.25		
J-I	-52 0	-18.5	-18.5 0.04 (4)	6.25		
I-H	-45 0	-18.5	-18.5 0.07 (4)	6.25		
H-G	-45 0	-18.5	-18.5 0.07 (4)	6.25		
G-N	-30 0	-18.5	-18.5 0.07 (1)	6.25		
N-F	-43 0	-18.5	-18.5 0.07 (1)	6.25		

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS: TC=0.22/1.00 (E-O:1), BC=0.07/1.00 (K-L:1), WB=0.11 1.00 (D-1), SS=0.14/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSH) (PLI) (PLJ)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.81 (C) (INPUT = 0.90)
 JSI METAL = 0.21 (E) (INPUT = 1.00)

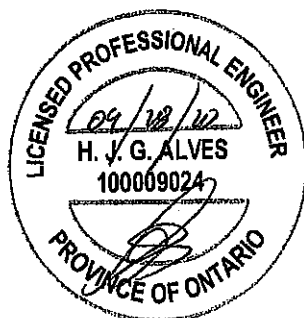


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	V4	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 8 Oct 2018 MTak Industries, Inc. Tue Apr 28 11:37:42 2020 Page 1

ID:DMCubINVR6TatF0a31v6l_zns11-NKaqA2aMCGI4MYH_q62VAKhU82Pb0QNm3fZNSPzMD_1

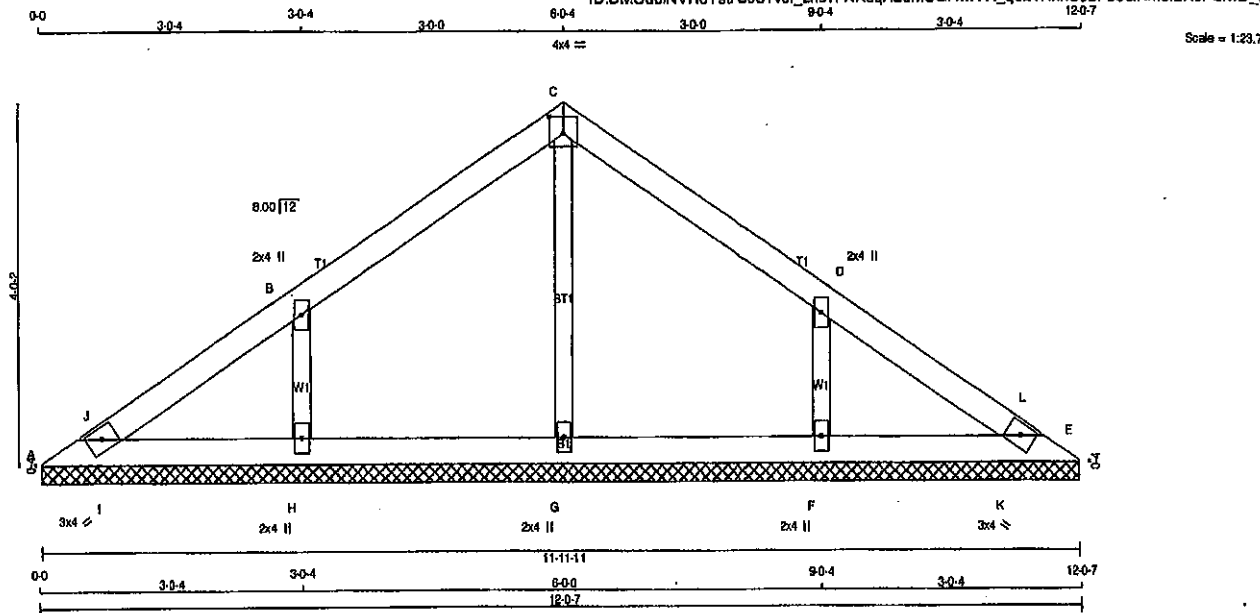

Scale = 1:23.7

TOTAL WEIGHT = 34 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - G	2x4	DRY	No.2	SPF		
C - E	2x4	DRY	No.2	SPF		
A - E	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
DRY: SEASONED LUMBER.						

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
A - TBM1-h	MT20	3.0	4.0			
B - TMW-w	MT20	2.0	4.0			
C - TTW-p	MT20	4.0	4.0	2.25	2.00	
D - TMW-w	MT20	2.0	4.0			
E - TBM1-h	MT20	3.0	4.0			
F, G, H						
F - BMW1-w	MT20	2.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
A	117	0	117	0	11-11-11	11-11-11
E	117	0	117	0	11-11-11	11-11-11
G	290	0	290	0	11-11-11	11-11-11
F	398	0	398	0	11-11-11	11-11-11
H	398	0	398	0	11-11-11	11-11-11

UNFACTORED REACTIONS

JT	COMBINED	SNOW		LIVE	PERM. LIVE	WIND	DEAD	SOIL
		1ST CASE	MAX. MIN. COMPONENT REACTIONS					
A	83	58/0	0/0	0/0	0/0	28/0	0/0	0/0
E	83	58/0	0/0	0/0	0/0	28/0	0/0	0/0
G	207	125/0	0/0	0/0	0/0	82/0	0/0	0/0
F	281	188/0	0/0	0/0	0/0	93/0	0/0	0/0
H	281	188/0	0/0	0/0	0/0	93/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, G, F, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (L)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (L)	LC1 (L)	
FR-TO		FROM TO			FR-TO				
A-J	-8/5	-91.8	-91.8	0.03 (1)	10.00	G-C	-248/0	0.08 (1)	
J-B	0/36	-91.8	-91.8	0.13 (1)	10.00	F-D	-314/0	0.05 (1)	
B-C	0/12	-91.8	-91.8	0.13 (1)	10.00	H-B	-314/0	0.05 (1)	
C-D	0/12	-91.8	-91.8	0.13 (1)	10.00	I-J	-47/4	0.00 (1)	
D-L	0/36	-91.8	-91.8	0.13 (1)	10.00	K-L	-47/4	0.00 (1)	
L-E	-8/5	-91.8	-91.8	0.03 (1)	10.00				
A-I	-13/0	-18.5	-18.5	0.05 (1)	6.25				
I-H	-10/0	-18.5	-18.5	0.05 (1)	10.00				
H-G	-20/0	-18.5	-18.5	0.04 (4)	6.25				
G-F	-20/0	-18.5	-18.5	0.04 (4)	6.25				
F-K	-10/0	-18.5	-18.5	0.05 (1)	10.00				
K-E	-13/0	-18.5	-18.5	0.05 (1)	6.25				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2015, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (B-J:1), BC=0.05/1.00 (A-I:1), WB=0.08/1.00 (G-G:1), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	818	354	1887

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.22 (D) (INPUT = 0.90)
JSI METAL = 0.16 (B) (INPUT = 1.00)

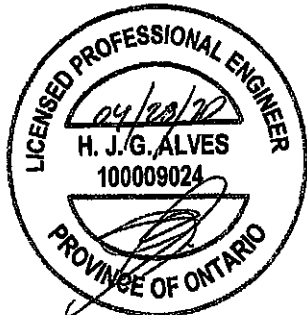

Structural component only
DWG# T-2007619

JOB NAME

408222

TRUSS NAME

V5

QUANTITY

1

PLY

1

JOB DESC.

GREEN PARK HOMES

DRWG NO.

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Tue Apr 28 09:00:17 2020 Page 1

ID:DMCubINVR6TslF0e31v6l_zns1t-QGREITKqWihCk2kk1_6ctz7N9ip5YjBYBi74lLzMFJS

Scale = 1:19.0

TOTAL WEIGHT = 23 lb

(M)

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF
B - C	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (tables in inches)

JT TYPE	PLATES	W	LEN	Y	X
A TBMI-h	MT20	3.0	4.0		
B TTW-p	MT20	4.0	4.0	2.25	2.00
C TBMI-h	MT20	3.0	4.0		
D BMWI+w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
A	49 0	49 0	8-11-11	8-11-11
C	49 0	49 0	8-11-11	8-11-11
D	893 0	893 0	8-11-11	8-11-11

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
A	34	22.0 0 0.0	0.0	0.0	12.0	0.0
C	34	22.0 0 0.0	0.0	0.0	12.0	0.0
D	631	415 0 0.0	0.0	0.0	216.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	CS (LC)
A-F	0 347	-91.8 -91.8 0.12 (1)	10.00	D-B	-688 0	0.12 (1)	
F-B	0 341	-91.8 -91.8 0.23 (1)	10.00	E-F	-225 0	0.00 (1)	
B-H	0 341	-91.8 -91.8 0.23 (1)	10.00	G-H	-225 0	0.00 (1)	
H-C	0 347	-91.8 -91.8 0.12 (1)	10.00				
A-E	-321 0	-18.5 -18.5 0.16 (1)	6.25				
E-D	-290 0	-18.5 -18.5 0.17 (1)	6.25				
D-G	-290 0	-18.5 -18.5 0.17 (1)	6.25				
G-C	-321 0	-18.5 -18.5 0.16 (1)	6.25				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019

- PART 9 OF OBC 2012 (2019 AMENDMENT)

- CSA 086-09, CSA 086-14

- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.23(1.00 (B-F:1), BC=0.17(1.00 (D-E:1), WB=0.12(1.00 (B-D:1), SS=0.12(1.00 (A-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1687 788 1687 1688

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 3.0 Deg.

JSI GRIP = 0.59 (B) (INPUT = 0.80)

JSI METAL = 0.20 (B) (INPUT = 1.00)

LICENSED PROFESSIONAL ENGINEER

09/28/20

H. J. G. ALVES

100009024


PROVINCE OF ONTARIO

Structural component only

DWG# T-2007620

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	PB1	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 26 09:00:02 2020 Page 1
ID:DMCubINVR6TstFoe31v6l zns11-MN1ZkL9Q2hoKQk4rKK5mpuqJ6FXyLks7nrjzMFh

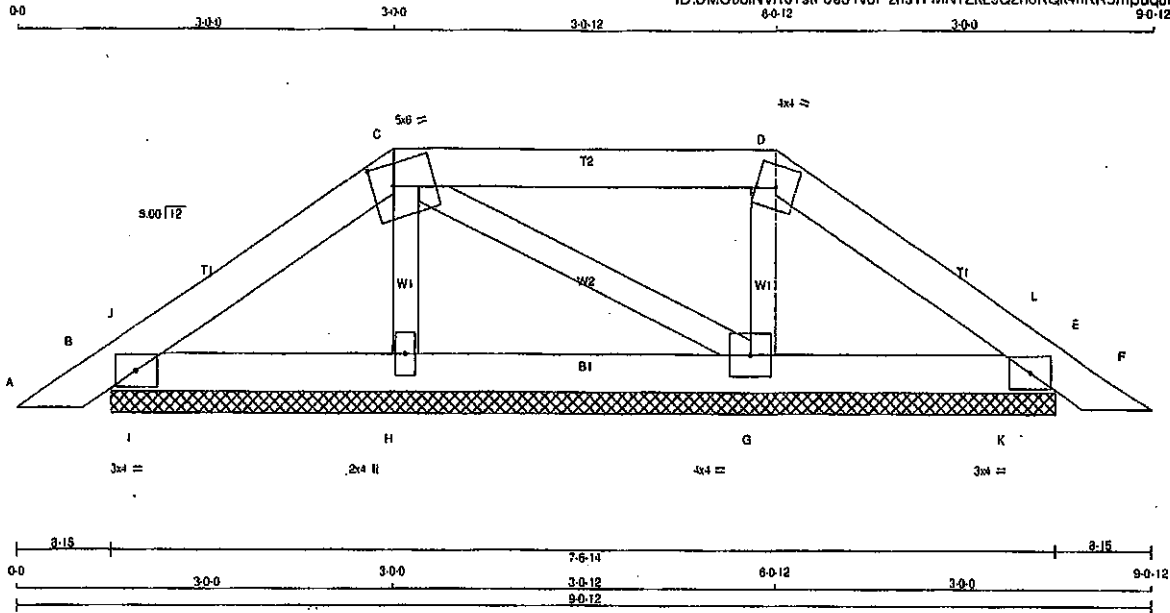

TOTAL WEIGHT = 2 X 25 = 50 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
B - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TM81-I	MT20	3.0	4.0	
C	TTW-m	MT20	5.0	6.0	2.00 2.00
D	TTW-m	MT20	4.0	4.0	
E	TM81-I	MT20	3.0	4.0	
G	BMWV-1-I	MT20	4.0	4.0	
H	BMWV-1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
B	221	0	221	0	0
E	209	0	209	0	0
H	248	0	248	0	0
G	280	0	280	0	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	154	113	0	0	0	0	41	0
E	146	108	0	0	0	0	39	0
H	178	109	0	0	0	0	87	0
G	188	127	0	0	0	0	71	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 15	-91.8 -91.8	0.03 (1)	H-C	-176 0	0.03 (1)	
B-J	-63 0	-91.8 -91.8	0.01 (1)	C-G	-21 0	0.00 (1)	
J-C	-75 0	-91.8 -91.8	0.05 (1)	G-D	-198 0	0.03 (1)	
C-D	-30 0	-91.8 -91.8	0.15 (1)	D-I	-121 0	0.00 (1)	
D-L	-54 0	-91.8 -91.8	0.05 (1)	L-K	-123 0	0.00 (1)	
L-E	-41 0	-91.8 -91.8	0.01 (1)				
E-F	0 15	-91.8 -91.8	0.03 (1)				
B-I	0 80	-18.5 -18.5	0.06 (1)				
I-H	0 60	-18.5 -18.5	0.06 (1)				
H-G	0 48	-18.5 -18.5	0.03 (1)				
G-K	0 43	-18.5 -18.5	0.06 (1)				
K-E	0 43	-18.5 -18.5	0.06 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6	PSF
DL	= 6.0	PSF
BOT CH. LL	= 0.0	PSF
DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.15/1.00 (C-D:1), BC=0.05/1.00 (B-I:1), WB=0.03/1.00 (D-G:1), SS=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP/DRY	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	818	354	1867 788 1887 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.18 (B) INPUT = 0.90
JSI METAL = 0.04 (B) INPUT = 1.00




Structural component only
DWG# T-2007600

JOB NAME 408222	TRUSS NAME PB2	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Tamirack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:00:03 2020 Page 1
ID:DMCubINVR6TslFoe31v6l_zns1l-qabxxh92p7wB2ul2D2sKJQJ7w31_GPEUzVWKN9zMFq

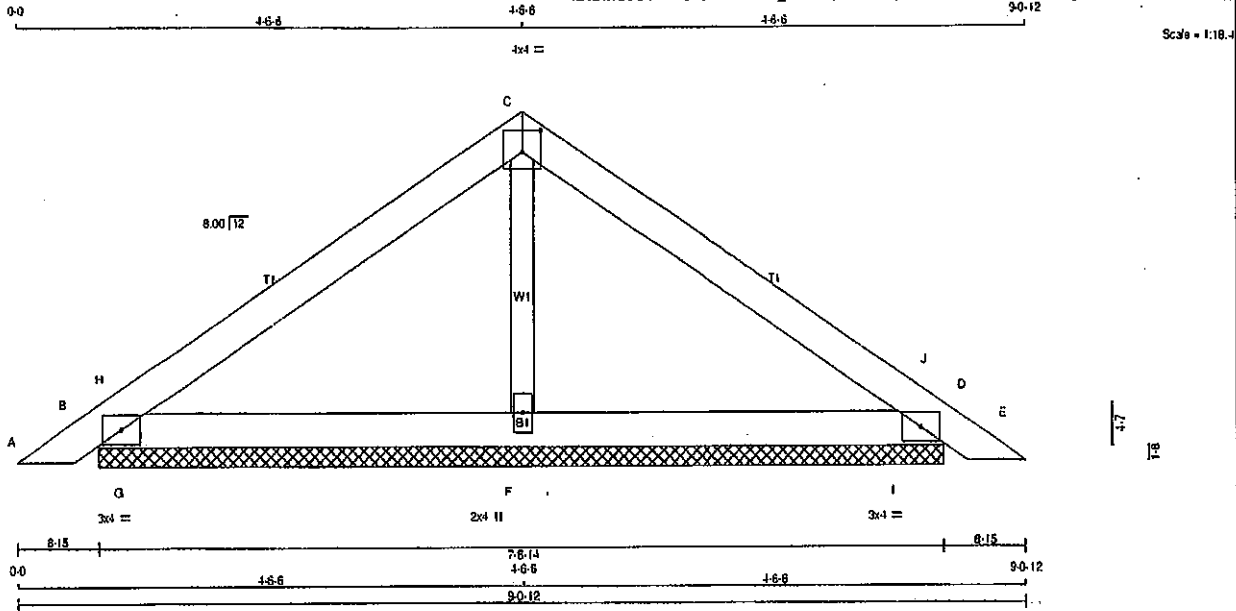

TOTAL WEIGHT = 2 X 23 = 46 k (M)

LUMBER				DESCR.	
N. L. G. A. RULES				SPF	
CHORDS	SIZE	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
B - D	2x4	DRY	No.2	SPF	
ALL WEBS 2x3 DRY				SPF	
DRY: SEASONED LUMBER.					

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-i	MT20	3.0	4.0	
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TMB1-i	MT20	3.0	4.0	
F	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
B	318	0	318	0	0	7-8-14	7-8-14
D	318	0	318	0	0	7-8-14	7-8-14
F	320	0	320	0	0	7-8-14	7-8-14

UNFACTORED REACTIONS

1ST LOOSE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	223	159	0	0	0	63	0
D	223	159	0	0	0	63	0
F	229	137	0	0	0	92	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0 15	-91.8 -91.8 0.03 (1)	10.00	F-C	-148 0	0.03 (1)	
B-H	-31 0	-91.8 -91.8 0.07 (1)	6.25	G-H	-349 0	0.00 (1)	
H-C	-135 0	-91.8 -91.8 0.10 (1)	6.25	I-J	-349 0	0.00 (1)	
C-J	-135 0	-91.8 -91.8 0.10 (1)	6.25				
J-D	-31 0	-91.8 -91.8 0.07 (1)	6.25				
D-E	0 15	-91.8 -91.8 0.03 (1)	10.00				
B-G	0 105	-18.5 -18.5 0.15 (1)	10.00				
G-F	0 105	-18.5 -18.5 0.15 (1)	10.00				
F-I	0 105	-18.5 -18.5 0.15 (1)	10.00				
I-D	0 105	-18.5 -18.5 0.15 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.18+1.00 (C-J); BC=0.15+1.00 (F-I); WB=0.03+1.00 (C-F); SS=0.26+1.00 (D-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 815 354 1867 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.28 (D) INPUT = 0.90
JSI METAL = 0.07 (D) INPUT = 1.00



Structural component only
DWG# T-2007601

JOB NAME 408223	TRUSS NAME PB20	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:03:56 2020 Page 1			
		ID:DMCubINVR6TslFoe31v6l zns11-6 izPKYM7hrKQxjFY7B9Jg2AAFEry9gNMkIPVzMEMr			
		8-4-5			

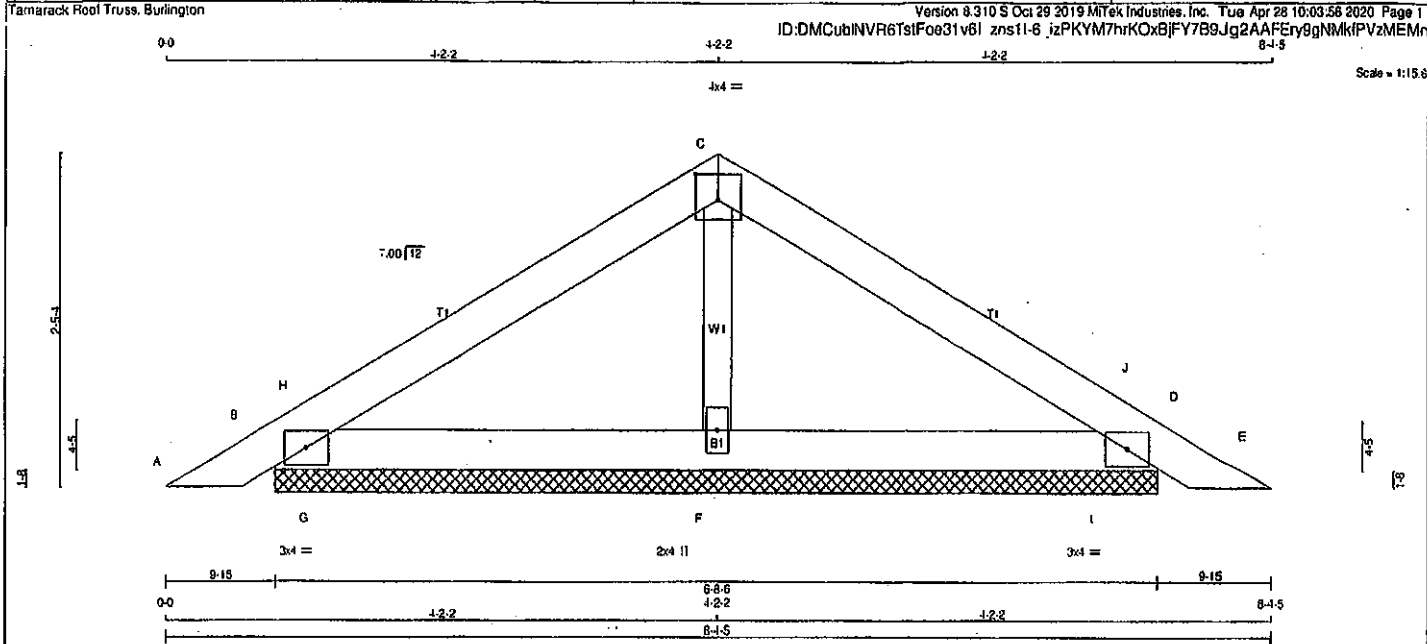

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
B - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TM81-I	MT20	3.0	4.0	
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TM81-I	MT20	3.0	4.0	
F	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
B	281	0	281	0	6-6-6	6-6-6	
D	281	0	281	0	6-6-6	6-6-6	
F	314	0	314	0	6-6-6	6-6-6	

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	197	141	0	0	0	55	0
D	197	141	0	0	0	55	0
F	224	137	0	0	0	87	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 16	-91.8	-91.8 0.04 (1)	10.00	F-C	-159 0	0.02 (1)
B-H	-44 0	-91.8	-91.8 0.05 (1)	6.25	G-H	-250 0	0.00 (1)
H-C	-99 0	-91.8	-91.8 0.12 (1)	6.25	I-J	-250 0	0.00 (1)
C-J	-99 0	-91.8	-91.8 0.12 (1)	6.25			
J-D	-44 0	-91.8	-91.8 0.05 (1)	6.25			
D-E	0 16	-91.8	-91.8 0.04 (1)	10.00			
B-G	0 81	-18.5	-18.5 0.12 (1)	10.00			
G-F	0 81	-18.5	-18.5 0.12 (1)	10.00			
F-I	0 81	-18.5	-18.5 0.12 (1)	10.00			
I-D	0 81	-18.5	-18.5 0.12 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (C-H:1), BC=0.12/1.00 (B-G:1), WB=0.02/1.00 (C-F:1), SS=0.18/1.00 (D-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP	DRY	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN	MAX MIN
MT20	618	354	1607	788 1907 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (D) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007627

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	PB21	1	1	TRUSS DESC.		

Tamrack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Matek Industries, Inc. Tue Apr 28 10:03:57 2020 Page 1
ID:DMCubINVR6TslFos31v6l zns11-aAGLdZ u zB05lvpFeQIXDDeZbFaPRpb0UDxxzMEMm

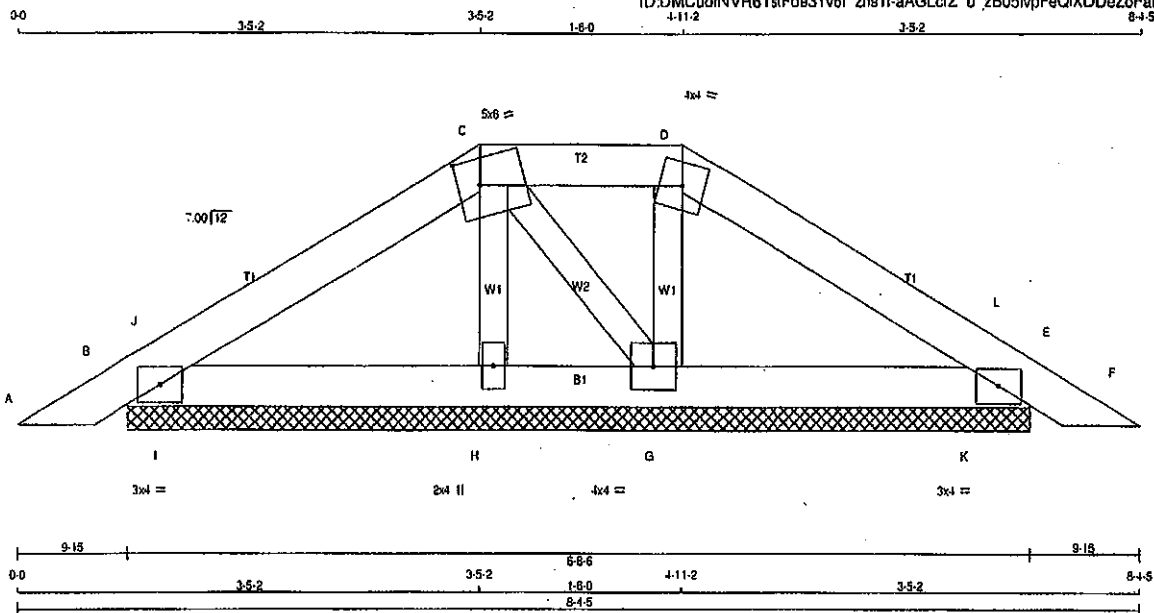

TOTAL WEIGHT = 22 lb

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESC
A - C	2x4	DRY	No.2		SPF
C - D	2x4	DRY	No.2		SPF
D - F	2x4	DRY	No.2		SPF
B - E	2x4	DRY	No.2		SPF
ALL WEBS		2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.					

PLATES (feet/inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-J	MT20	3.0	4.0		
C	TTWW-m	MT20	5.0	8.0	2.25	2.00
D	TTW-m	MT20	4.0	4.0		
E	TMB1-J	MT20	3.0	4.0		
G	BMWW1-I	MT20	4.0	4.0		
H	BMWW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
B	241	0	241	0	0	6-8-6	6-8-6	6-8-6
E	228	0	228	0	0	6-8-6	6-8-6	6-8-6
H	170	0	170	0	0	6-8-6	6-8-6	6-8-6
G	238	0	238	0	0	6-8-6	6-8-6	6-8-6

UNFACTORED REACTIONS

MAX./MIN. COMPONENT REACTIONS							
JT	1ST CASE COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
B	189	121 0	0 0	0 0	0 0	48 0	0 0
E	160	114 0	0 0	0 0	0 0	48 0	0 0
H	122	74 0	0 0	0 0	0 0	48 0	0 0
G	168	111 0	0 0	0 0	0 0	57 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LOAD LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LOAD LC1 (LC)
FR-TO				FR-TO			
A-B	0	16	-91.8	H-C	-107	0	0.02 (1)
B-J	-59	0	-91.8	C-G	-36	0	0.01 (1)
J-C	-71	0	-91.8	G-D	-147	0	0.02 (1)
C-D	-28	0	-91.8	D-I	-139	0	0.00 (1)
D-L	-46	0	-91.8	K-L	-141	0	0.00 (1)
L-E	-33	0	-91.8				
E-F	0	16	-91.8				
B-I	0	59	-18.5				
I-H	0	59	-18.5				
H-G	0	52	-18.5				
G-K	0	38	-18.5				
K-E	0	38	-18.5				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012: A&C 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.07:1.00 (D-L:1), BC=0.07:1.00 (B-E:1), WB=0.02:1.00 (D-G:1), SSI=0.11:1.00 (E-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1887 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.19 (B) (INPUT = 0.90)
JSI METAL = 0.05 (D) (INPUT = 1.00)



Structural component only
DWG# T-2007628

JOB NAME 408223	TRUSS NAME PB22	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:03:58 2020 Page 1
ID:DMCubINVR6TsiFoe31v6l_zns11-2Mqj7acil52eFK5Nz9IEkmO2zyGJsPzqgDmTNzMEMI

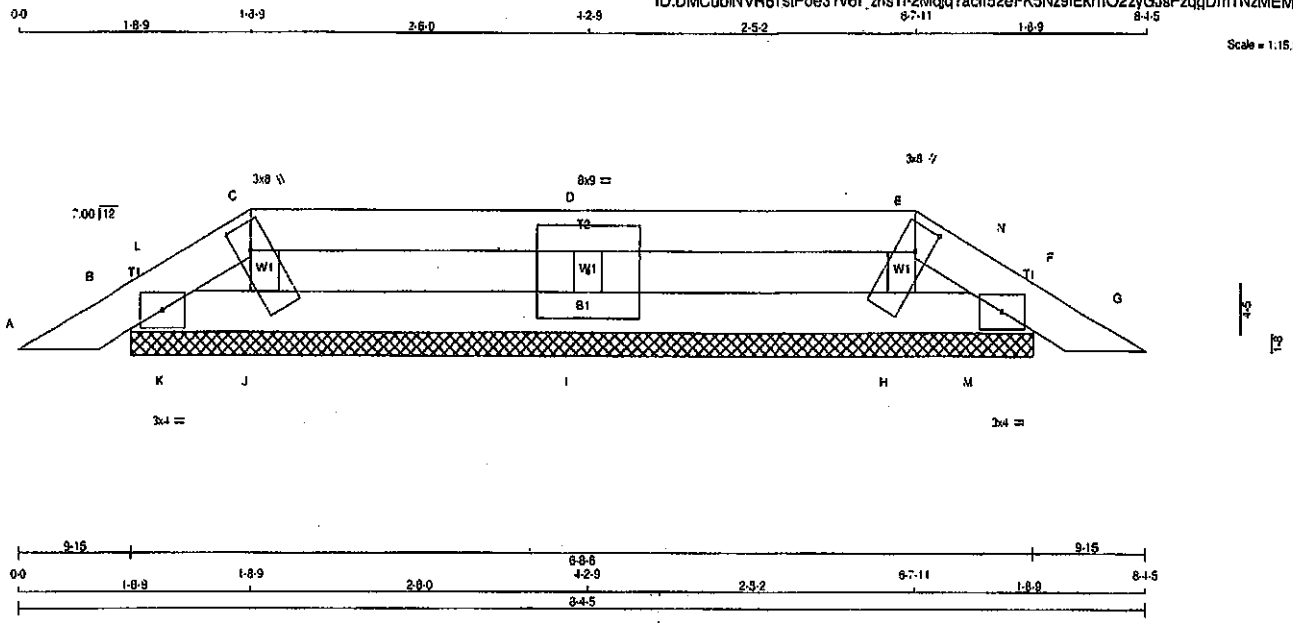

TOTAL WEIGHT = 18 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
B - F	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY
DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMB1-I	MT20	3.0	4.0		
C D E H I J					
D TTBW1+H	MT20	3.0	8.0	2.25	1.25
D TMBW1-I	MT20	8.0	9.0		
E TTBW1+H	MT20	3.0	8.0	2.25	1.25
F TMB1-I	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORIZ		
B	151	0	151	0	6-8-6	6-8-6
F	152	0	152	0	6-8-6	6-8-6
J	125	0	125	0	6-8-6	6-8-6
H	120	0	120	0	6-8-6	6-8-6
I	330	0	330	0	6-8-6	6-8-6

UNFACTORED REACTIONS

JT	1ST LOASE COMBINED	MAX./MIN. COMPONENT REACTIONS				WIND	DEAD	SOIL
		SNOW	LIVE	PERM.LIVE	IN-SX			
B	105	83	0	0	0	21	0	0
F	105	83	0	0	0	22	0	0
J	90	49	0	0	0	41	0	0
H	86	47	0	0	0	39	0	0
I	232	158	0	0	0	74	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F, J, H, I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	MAX. FACTORED CSI (LC)
FR-TO				FR-TO			
A-B	0 16	-91.8	-91.8 0.04 (1)	10.00	J-C	-95 0	0.01 (1)
B-L	-53 0	-91.8	-91.8 0.04 (1)	6.25	I-E	-92 0	0.01 (1)
L-C	-22 0	-91.8	-91.8 0.01 (1)	6.25	I-D	-282 0	0.04 (1)
C-D	0 3	-91.8	-91.8 0.09 (1)	10.00	K-L	-1 12	0.00 (1)
D-E	0 3	-91.8	-91.8 0.09 (1)	10.00	M-N	0 13	0.00 (1)
E-N	-21 0	-91.8	-91.8 0.01 (1)	6.25			
N-F	-52 0	-91.8	-91.8 0.04 (1)	6.25			
F-G	0 16	-91.8	-91.8 0.04 (1)	10.00			
B-K	0 14	-18.5	-18.5 0.01 (1)	10.00			
K-J	0 14	-18.5	-18.5 0.02 (4)	10.00			
J-I	-3 0	-18.5	-18.5 0.02 (4)	10.00			
I-H	-3 0	-18.5	-18.5 0.02 (4)	10.00			
H-M	0 14	-18.5	-18.5 0.01 (4)	10.00			
M-F	0 14	-18.5	-18.5 0.01 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.
65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.08/1.00 (D-E:1), BC=0.02/1.00 (I-J:4).
WB=0.04/1.00 (D-I:1), SS=0.1/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

MAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.13 (C) INPUT = 0.90
JSI METAL = 0.04 (C) INPUT = 1.00




Structural component only
DWG# T-2007629

JOB NAME 408223	TRUSS NAME P20	QUANTITY 17	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	-----------------------	-----------------	--------------------------------------	-------------	----------

TanRack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:03:55 2020 Page 1
ID:DMCubINVR6TslFoe31v6l zns11-en8bC XkMNIUnocWqbyd68sgmus6UhwB17612zMEMO

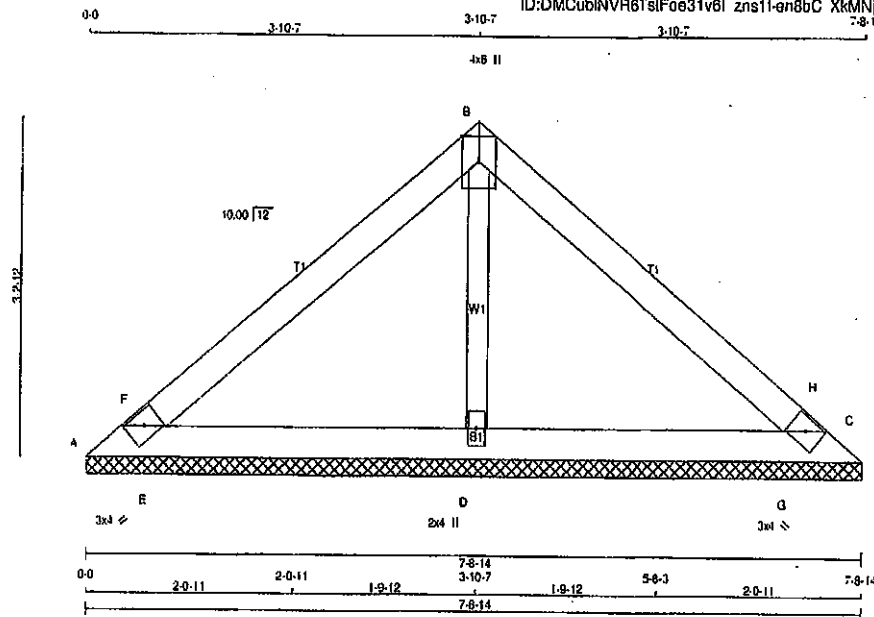

Scale = 1:20.4

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
A - C	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TBM1-h	MT20	3.0	4.0
B	TTW+p	MT20	4.0	6.0 Edge
C	TBM1-h	MT20	3.0	4.0
D	BMW1-w	MT20	2.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS						
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	IN-SX	IN-SX
A	80	0	0	0	7-8-14	7-8-14
C	80	0	0	0	7-8-14	7-8-14
D	733	0	0	0	7-8-14	7-8-14

UNFACTORED REACTIONS

JT	1ST CASE	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	43	28	0	0	0	0	14	0
C	42	28	0	0	0	0	14	0
D	518	339	0	0	0	0	179	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		FR-TO			
A-F	0 227	-91.8 -91.8 0.09 (1)	10.00	D-B	-558 0	0.10 (1)	
F-B	0 219	-91.8 -91.8 0.17 (1)	10.00	E-F	-189 0	0.00 (1)	
B-H	0 219	-91.8 -91.8 0.17 (1)	10.00	G-H	-199 0	0.00 (1)	
H-C	0 228	-91.8 -91.8 0.09 (1)	10.00				
A-E	-207 0	-18.5 -18.5 0.13 (1)	6.25				
E-D	-174 0	-18.5 -18.5 0.13 (1)	6.25				
D-G	-174 0	-18.5 -18.5 0.13 (1)	6.25				
G-C	-207 0	-18.5 -18.5 0.13 (1)	6.25				

TOTAL WEIGHT = 17 X 21 = 363 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS: TC=0.17 1.00 (B-F:1), BC=0.13 1.00 (D-E:1),
WB=0.10 1.00 (B-D:1), SS=0.11 1.00 (C-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1997 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.29 (D) (INPUT = 0.90)
JSI METAL= 0.12 (D) (INPUT = 1.00)



Structural component only
DWG# T-2007626



TOTAL WEIGHT = 21 X 17 = 353 lb

DESCR.
SPF
SPF
SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT IN-SX	IN-SX
E	525	0	525	0	0	5-8
C	202	0	202	0	0	1-8
D	45	0	50	0	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C.D.

UNFACTORED REACTIONS

ISTLCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	389	257 0	0 0	0 0	0 0	111 0	0 0
C	139	113 0	0 0	0 0	0 0	28 0	0 0
D	38	0 0	0 0	0 0	0 0	38 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: 14)

CHORUS				WEBS			
MAX. FACTORED		FACTORED		FACTORED		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. CS (LBS)	MAX. CS (LBS)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)
FR-TO		FROM	TO			FR-TO	
E-B	-451 0	0.0	0.0	0.13 (4)	7.81		
A-B	0 28	-91.8	-91.8	0.12 (1)	10.00		
B-C	-30 0	-91.8	-91.8	0.54 (1)	6.25		
E-D	0 0	-18.5	-18.5	0.13 (4)	10.00		

WEBS

MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS (LC)
-------	---------------------------------	----------------

DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL	n	25.8	PSF
		DL	=	6.0	PSF
BOT	CH.	LL	n	0.0	PSF
		DL	=	7.4	PSF
TOTAL LOAD				w	39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9.
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018 . OBC 2012 . ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEFL.(LL)= L 380 (0.20")
CALCULATED VERT. DEFL.(LL) = L 999 (0.00")
ALLOWABLE DEFL.(TL)= L 360 (0.20")

CS: TC=0.54, 1.00 (B-C:1), BC=0.13, 1.00 (D-E:4),
WB=0.00, 1.00 (avg:0), SS=0.24, 1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1087	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 | E1 | INPUT = 0.90 |




Structural component only
DWG# T-2007598

JOB NAME 408222	TRUSS NAME J2S	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamburack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 29 09:00:01 2020 Page 1

ID:DMCubINVR6TatFoe31v6I_zns1I-uBTBW?8oHNgUpvV5dpsEblnFOVoU/BWCFEIHZMFI

Scale = 1:31.3

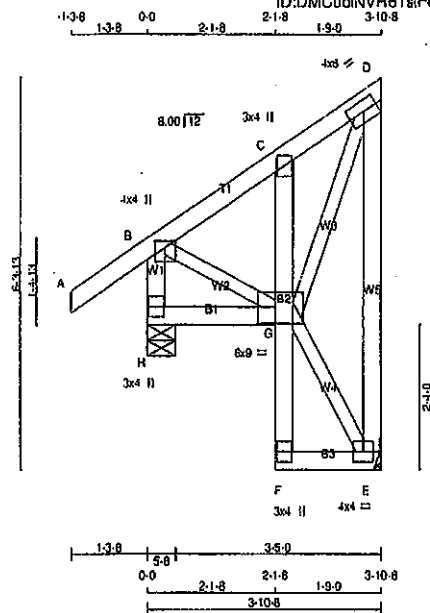

TOTAL WEIGHT = 4 X 31 = 125 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
H - B	2x4	DRY	No.2
A - D	2x4	DRY	No.2
H - G	2x4	DRY	No.2
F - C	2x4	DRY	No.2
F - E	2x4	DRY	No.2

ALL WEBS EXCEPT			
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)			
JT TYPE	PLATES	W	LEN Y X
B	TMW+p	MT20	4.0 4.0 1.25 2.00
C	TMW+p	MT20	3.0 4.0
D	TMW+I	MT20	4.0 6.0 2.00 2.75
E	BMW+I	MT20	4.0 4.0
F	BMW+p	MT20	3.0 4.0
G	BMW+WW-I	MT20	6.0 9.0 3.25 3.50
H	BMW+p	MT20	3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT REORD
H	VERT 332	DOWN 332	BRG 5-8
E	HORZ 208	HORZ 208	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS			
JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	
H	COMBINED	SNOW 188 0	LIVE 0 0
E	COMBINED	SNOW 95 0	LIVE 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)
H-B	-311 0	0.0	0.0
A-B	0 35	-91.8	-91.8
B-C	-96 0	-91.8	-91.8
C-D	-105 0	-91.8	-91.8
H-G	0 0	-18.5	-18.5
F-G	0 15	0.0	0.0
G-C	-202 0	0.0	0.0
F-E	0 4	-18.5	-18.5

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9. NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.14 (1.00 (A-B-5), 8C=0.03 (1.00 (G-H-4), WB=0.08 (1.00 (D-E-1), SS)=0.09 (1.00 (A-B-5))

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1667 788 1907 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.22 (B) INPUT = 0.90
JSI METAL = 0.07 (C) INPUT = 1.00



Structural component only
DWG# T-2007599

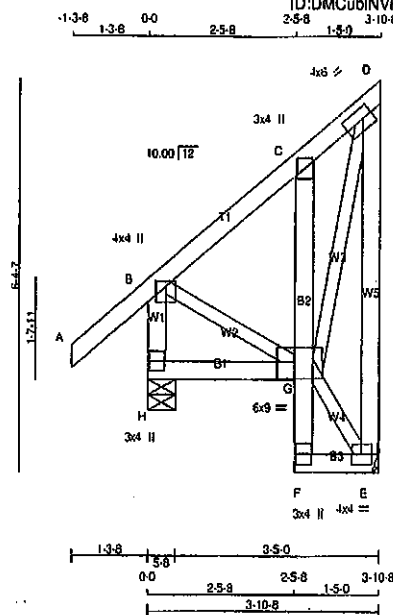

MI

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	= 25.6	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9.
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 • PART 9 OF BCBC 2018, OBC 2012, ABC 2019
 • PART 9 OF OBC 2012 (2019 AMENDMENT)
 • CSA 086-09, CSA 086-14
 • TPIC 2011, TPIC 2014

65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEFL.(LL) = L 360 (0.19")
CALCULATED VERT. DEFL.(LL) = L 999 (0.00")
ALLOWABLE DEFL.(TL) = L 360 (0.19")
CALCULATED VERT. DEFL.(TL) = L 999 (0.00")

CSI: TC=0.14/1.00 (A-B:5), BC=0.04/1.00 (G-H:4),
WB=0.08/1.00 (D-E:1), SS=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY Y

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES				
PLATE	GRIP (DRY)	SHEAR		SECTION
	(PSI)	(PLI)		(PLI)
	MAX	MIN	MAX	MIN
MT20	818	354	1667	709
			1987	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.24 (B) (INPUT = 0.90)
JSI METAL= 0.08 (C) (INPUT = 1.00)

DRY: SEASONED LUMBER

PLATES (tablets in [n]phes)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TMV+p		3.0	4.0		
D	TMVW-t	MT20	4.0	6.0	2.00	2.00
E	BMVW-I	MT20	4.0	4.0		
F	BMV+p		3.0	4.0		
G	BMVWVW-I	MT20	6.0	9.0	3.25	3.50
H	BMV-I	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
H	333	0	333	0	0	5-8	5-8
E	208	0	208	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	233	166 0	0 0	0 0	0 0	67 0	0 0
E	145	95 0	0 0	0 0	0 0	50 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	LC1 P/LF	MAX CS1 (LC1)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC1)	
FR-TO		FROM TO				FR-TO			
H-B	-309 0	0.0	0.0	0.03 (1)	7.81	B-G	0 70	0.02 (1)	
A-B	0 41	-91.8	-91.8	0.14 (5)	10.00	E-D	-185 0	0.06 (1)	
B-C	-709 0	-91.8	-91.8	0.07 (1)	8.25	G-E	-13 0	0.00 (1)	
C-D	-92 0	-91.8	-91.8	0.06 (1)	6.25	G-D	0 215	0.05 (1)	
H-G	0 0	-18.5	-18.5	0.04 (4)	10.00				
F-G	0 12	0.0	0.0	0.02 (1)	10.00				
G-C	-216 0	0.0	0.0	0.02 (1)	7.81				
E-E	0 8	-18.5	-18.5	0.01 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN



Structural component only
DWG# T-2007623

JOB NAME

408223

TRUSS NAME

J21

QUANTITY

4

PLY

1

JOB DESC.

GREEN PARK HOMES

DRWG NO.

TRUSS DESC.

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:03:53 2020 Page 1

ID:DMCubINVR6TstFos31v6l_zns1l-hP0qnWUqmTmXUS8aPZUYh3VGyCuebnDgOW7oAzMEMQ

Scale = 1:10.0

LUMBER

N.L.G.A. RULES

CHORDS SIZE

A - C 2x4 DRY No.2

B - D 2x4 DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE PLATES W LEN Y X

B TMB1-1 MT20 3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
C	175 0	175 0	1-8	1-8
B	385 0	385 0	5-8	5-8
D	67 0	67 0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
C	121	94 0	0 0	0 0	0 0	27 0	0 0
B	256	181 0	0 0	0 0	0 0	75 0	0 0
D	50	18 0	0 0	0 0	0 0	32 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MAX. FACTORED MOMENT (LBS-FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED MOMENT (LBS-FT)
FR-TO	0 23	-91.8	-91.8	0.12 (1)	10.00	E-F	-235 7
A-B	-17 13	-91.8	-91.8	0.04 (4)	8.25		
B-C	-1 2	-91.8	-91.8	0.23 (1)	10.00		
B-E	0 0	-18.5	-18.5	0.16 (1)	10.00		
E-D	0 0	-18.5	-18.5	0.16 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

PART 9 OF CBC 2018, OBC 2012, ABC 2019

PART 9 OF OBC 2012 (2019 AMENDMENT)

CSA 086-09, CSA 086-14

TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")

CALCULATED VERT. DEFL.(LL) = L/999 (0.02")

ALLOWABLE DEFL.(TL) = L/360 (0.19")

CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.23/1.00 (C-F:1), BC=0.16/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SB=0.19/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1867 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.26 (B) (INPUT = 0.90)

JSI METAL = 0.07 (B) (INPUT = 1.00)

LICENSED PROFESSIONAL ENGINEER

04/28/20

H. J. G. ALVES

100009024

PROVINCE OF ONTARIO

Structural component only

DRWG# T-2007624

JOB NAME 408223	TRUSS NAME J22	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 5 Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:03:54 2020 Page 1	
				ID:DMCubINVR6TstFoe31v6l zns1l-AbaD eX6b3bd9e1K874j4ubglMZPN21Nv2FYKczMEMp	

Scale = 1/2" = 1'-0"

LUMBER N.L.G.A. RULES CHORDS SIZE LUMBER F - B 2x4 DRY No.2 SPF A - C 2x4 DRY No.2 SPF F - D 2x4 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF DRY: SEASONED LUMBER.	DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 8.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF BCBC 2018, OBC 2012, ABC 2019 - PART 9 OF OBC 2012 (2019 AMENDMENT) - CSA 088-09, CSA 088-14 - TPIC 2011, TPIC 2014 155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL) = L/360 (0.19") CALCULATED VERT. DEFL.(LL) = L/999 (0.00") ALLOWABLE DEFL.(TL) = L/360 (0.19") CALCULATED VERT. DEFL.(TL) = L/999 (0.01") CSI: TC=0.23/1.00 (B-C:1), BC=0.08/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.11/1.00 (B-C:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 1.00 AUTOSOLVE RIGHT HEEL ONLY TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1687 788 1987 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP = 0.24 (B) INPUT = 0.90 JSI METAL = 0.05 (B) INPUT = 1.00	DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS <table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th rowspan="2">JT</th> <th colspan="2">FACTORED GROSS REACTION</th> <th colspan="2">MAXIMUM FACTORED GROSS REACTION</th> <th rowspan="2">INPUT BRG IN-SX</th> <th rowspan="2">REORD BRG IN-SX</th> </tr> <tr> <th>VERT</th> <th>HORZ</th> <th>DOWN</th> <th>HORZ</th> </tr> </thead> <tbody> <tr> <td>F</td> <td>341</td> <td>0</td> <td>341</td> <td>0</td> <td>5-8</td> <td>5-8</td> </tr> <tr> <td>C</td> <td>178</td> <td>0</td> <td>178</td> <td>0</td> <td>1-8</td> <td>1-8</td> </tr> <tr> <td>D</td> <td>36</td> <td>0</td> <td>40</td> <td>0</td> <td>1-8</td> <td>1-8</td> </tr> </tbody> </table> SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D UNFACTORED REACTIONS <table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th rowspan="2">JT</th> <th rowspan="2">COMBINED</th> <th colspan="6">MAX. MIN. COMPONENT REACTIONS</th> </tr> <tr> <th>1ST LCASE</th> <th>SNOW</th> <th>LIVE</th> <th>PERM. LIVE</th> <th>WIND</th> <th>DEAD</th> <th>SOIL</th> </tr> </thead> <tbody> <tr> <td>F</td> <td>239</td> <td>170</td> <td>0</td> <td>0.0</td> <td>0</td> <td>0</td> <td>69</td> <td>0</td> </tr> <tr> <td>C</td> <td>122</td> <td>99</td> <td>0</td> <td>0.0</td> <td>0</td> <td>0</td> <td>23</td> <td>0</td> </tr> <tr> <td>D</td> <td>29</td> <td>0</td> <td>0</td> <td>0.0</td> <td>0</td> <td>0</td> <td>28</td> <td>0</td> </tr> </tbody> </table> BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (5) <table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th rowspan="3">MEMB.</th> <th rowspan="3">MAX. FACTORED FORCE (LBS)</th> <th colspan="4">CHORDS</th> <th colspan="4">WEBS</th> </tr> <tr> <th rowspan="2">VERT. LOAD (PLF)</th> <th rowspan="2">LC1 MAX</th> <th rowspan="2">MAX. CSI (LC)</th> <th rowspan="2">UNBRAC LENGTH</th> <th rowspan="2">MEMB. FORCE (LBS)</th> <th rowspan="2">MAX. FACTORED CSI (LC)</th> <th rowspan="2">MAX. CSI (LC)</th> </tr> <tr> <th>FROM TO</th> <th>FROM TO</th> </tr> </thead> <tbody> <tr> <td>F-B</td> <td>-305</td> <td>0</td> <td>0.0</td> <td>0.0</td> <td>0.03 (1)</td> <td>7.81</td> <td>B-E</td> <td>0</td> <td>0</td> <td>0.00 (1)</td> </tr> <tr> <td>A-B</td> <td>0</td> <td>41</td> <td>-81.8</td> <td>-91.8</td> <td>0.14 (5)</td> <td>10.00</td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>B-C</td> <td>0</td> <td>0</td> <td>-91.8</td> <td>-91.8</td> <td>0.23 (1)</td> <td>10.00</td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>F-E</td> <td>0</td> <td>0</td> <td>-18.5</td> <td>-18.5</td> <td>0.08 (4)</td> <td>10.00</td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>E-D</td> <td>0</td> <td>0</td> <td>-18.5</td> <td>-18.5</td> <td>0.08 (4)</td> <td>10.00</td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table> CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN	JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REORD BRG IN-SX	VERT	HORZ	DOWN	HORZ	F	341	0	341	0	5-8	5-8	C	178	0	178	0	1-8	1-8	D	36	0	40	0	1-8	1-8	JT	COMBINED	MAX. MIN. COMPONENT REACTIONS						1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	F	239	170	0	0.0	0	0	69	0	C	122	99	0	0.0	0	0	23	0	D	29	0	0	0.0	0	0	28	0	MEMB.	MAX. FACTORED FORCE (LBS)	CHORDS				WEBS				VERT. LOAD (PLF)	LC1 MAX	MAX. CSI (LC)	UNBRAC LENGTH	MEMB. FORCE (LBS)	MAX. FACTORED CSI (LC)	MAX. CSI (LC)	FROM TO	FROM TO	F-B	-305	0	0.0	0.0	0.03 (1)	7.81	B-E	0	0	0.00 (1)	A-B	0	41	-81.8	-91.8	0.14 (5)	10.00					B-C	0	0	-91.8	-91.8	0.23 (1)	10.00					F-E	0	0	-18.5	-18.5	0.08 (4)	10.00					E-D	0	0	-18.5	-18.5	0.08 (4)	10.00				
JT	FACTORED GROSS REACTION			MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REORD BRG IN-SX																																																																																																																																															
	VERT	HORZ	DOWN	HORZ																																																																																																																																																		
F	341	0	341	0	5-8	5-8																																																																																																																																																
C	178	0	178	0	1-8	1-8																																																																																																																																																
D	36	0	40	0	1-8	1-8																																																																																																																																																
JT	COMBINED	MAX. MIN. COMPONENT REACTIONS																																																																																																																																																				
		1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL																																																																																																																																														
F	239	170	0	0.0	0	0	69	0																																																																																																																																														
C	122	99	0	0.0	0	0	23	0																																																																																																																																														
D	29	0	0	0.0	0	0	28	0																																																																																																																																														
MEMB.	MAX. FACTORED FORCE (LBS)	CHORDS				WEBS																																																																																																																																																
		VERT. LOAD (PLF)	LC1 MAX	MAX. CSI (LC)	UNBRAC LENGTH	MEMB. FORCE (LBS)	MAX. FACTORED CSI (LC)	MAX. CSI (LC)																																																																																																																																														
									FROM TO	FROM TO																																																																																																																																												
F-B	-305	0	0.0	0.0	0.03 (1)	7.81	B-E	0	0	0.00 (1)																																																																																																																																												
A-B	0	41	-81.8	-91.8	0.14 (5)	10.00																																																																																																																																																
B-C	0	0	-91.8	-91.8	0.23 (1)	10.00																																																																																																																																																
F-E	0	0	-18.5	-18.5	0.08 (4)	10.00																																																																																																																																																
E-D	0	0	-18.5	-18.5	0.08 (4)	10.00																																																																																																																																																

TOTAL WEIGHT = 3 X 15 = 45 lb

(M)


Structural component only
 DWG# T-2007625

JOB NAME 408224	TRUSS NAME J40	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Tambrack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:19:52 2020 Page 1
ID:DMCubINVR6TstF0e31v8l zns11-6uTN2C71 PHh5sGSGJGMvwHM_XXOqKBNc5JFy4zME7r

Scale = 1:20.9

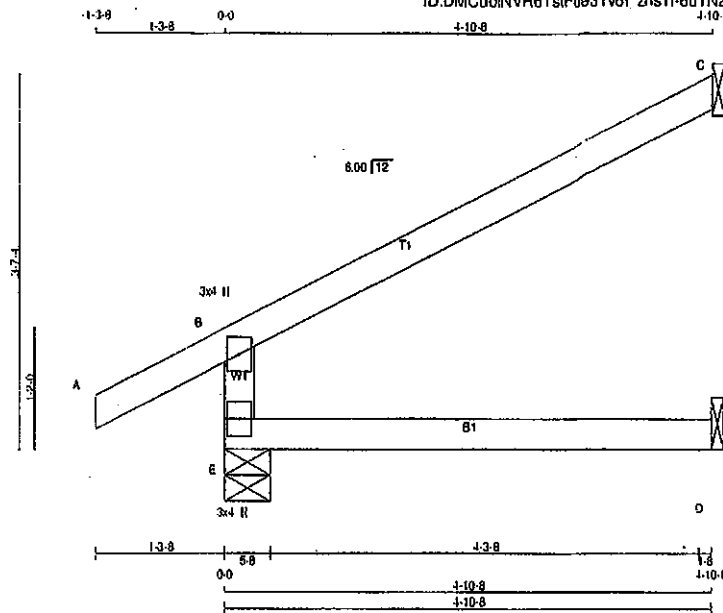

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y
B	TMV+p	MT20	3.0	4.0	
E	BMV+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG	IN-SX	IN-SX	
E	456	0	456	0	5-8	5-8	
C	168	0	168	0	1-8	1-8	
D	38	0	42	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) E, C, D

UNFACTORED REACTIONS							
JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD
E	320	225	0	0	0	0	95
C	116	94	0	0	0	0	22
D	30	0	0	0	0	0	30

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
E-B	-404	0	0.0	0.08	(4)	7.81	
A-B	0	28	-91.8	-91.8	0.12	(1)	10.00
B-C	-25	0	-91.8	-91.8	0.37	(1)	6.25
E-D	0	0	-18.5	-18.5	0.09	(4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPKC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/399 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.18")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.37 1.00 (B-C:1), 8C=0.09/1.00 (D-E:4), WB=0.00/1.00 (rva:0), SSI=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.17 (E) (INPUT = 0.90)
JSI METAL = 0.11 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007657


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	J41	5	1	TRUSS DESC.		

Tamprack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:54 2020 Page 1

ID:DMCubINVR6TslFoe31v6l 2ns11-3H67Tu8HW1XPKAQqNkQq_LMmLEmIEhgIPoM1zzME7p

Scale = 1:17.8

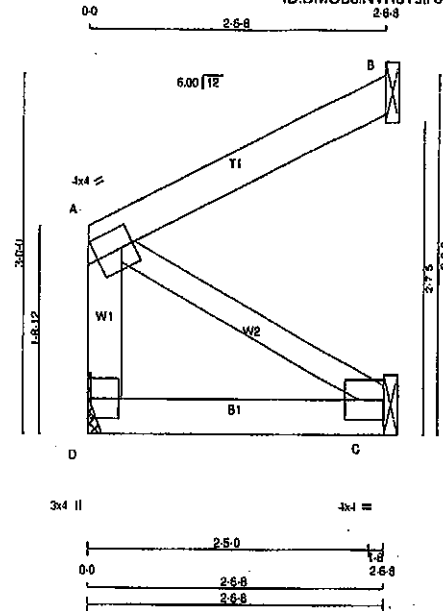

<u>LUMBER</u>					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR
D - A	2x4	DRY	No.2		SPF
A - B	2x4	DRY	No.2		SPF
D - C	2x4	DRY	No.2		SPF
ALL WEBS		2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW	4	MT20	4.0	4.0	2.00	1.25
C	BMW	1	MT20	4.0	4.0	2.00	Edge
D	BMV	1	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
	VERT	DOWN	IN-SX	IN-SX
JT	139	0	0	0
D	139	0	0	0
B	117	0	1-8	1-8
C	23	0	1-8	1-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C.

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	98	65	0	0	0	33	0
B	80	65	0	0	0	15	0
C	18	0	0	0	0	18	0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	W E B S	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
D-A	-117	0.0	0.0	0.0
A-B	0	-91.8	-91.8	0.0
D-C	0	-18.5	-18.5	0.0

TOTAL WEIGHT = 5 X 10 = 49 lb [M][F]

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.10/1.00 (A-B:1), BC=0.03/1.00 (C-D:4), WB=0.00/1.00 (A-C:1), SSI=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PS)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1687 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.07 (A) (INPUT = 0.90)
JSI METAL= 0.02 (A) (INPUT = 1.00)



Structural component only
DWG# T-2007658

JOB NAME

408224

TRUSS NAME

C40

QUANTITY

2

PLY

1

JOB DESC.

GREEN PARK HOMES

DRWG NO.

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:42 2020 Page 1

ID:DMCubINVR6TslFoe31v8l zns1l-Pzsbyo?ILL16uKVXgD50VpshpV5QUojvXujdzME8?

Scale = 1:17.0

LUMBER

N. L. G. A. RULES

CHORDS

SIZE

ORY

No. 2

E - B

2x4

ORY

No. 2

A - C

2x4

ORY

No. 2

E - D

2x4

ORY

No. 2

DRY: SEASONED LUMBER.

DESOR.

SPF

SPF

SPF

PLATES (table is in inches)

JT

TYPE

PLATES

W

LEN

Y

X

B

TMV+p

MT20

3.0

4.0

E

BMV1+p

MT20

3.0

4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED

GROSS REACTION

MAXIMUM FACTORED

GROSS REACTION

INPUT

REQD

JT

VERT

HORZ

DOWN

HORZ

UPLIFT

IN-SX

IN-SX

E

405

0

405

0

0

5-8

5-8

C

130

0

130

0

0

1-8

1-8

D

45

0

50

0

0

1-8

1-8

SEE MITEK STANDARD DETAIL B97781H FOR CONNECTION TO JOINTS) C, D

UNFACTORED REACTIONS

1ST LCASE

MAX. MIN. COMPONENT REACTIONS

JT

COMBINED

SNOW

LIVE

PERM. LIVE

WIND

DEAD

SOIL

E

288

190

0

0

0

0

0

C

90

73

0

0

0

0

0

D

38

0

0

0

0

0

0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS

MAX. FACTORED

FACTORED

WEBS

MAX. FACTORED

MEMB.

FORCE

VERT. LOAD

LC1

MAX.

MAX.

MEMB.

FORCE

MAX.

FR-TO

(LBS)

(PLF)

CSI (LC)

UNBRAC

LENGTH

FR-TO

E-B

-342

0

0.0

0.0

0.13 (4)

7.81

A-B

0

28

-91.8

-91.8

0.12 (1)

10.00

B-C

-19

0

-91.8

-91.8

0.22 (1)

6.25

E-D

0

0

-18.5

-18.5

0.13 (4)

10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

PART 9 OF CBC 2018, OBC 2012, ABC 2019

PART 9 OF OBC 2012 (2019 AMENDMENT)

CSA 086-09, CSA 086-14

TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")

CALCULATED VERT. DEFL.(LL) = L/999 (0.00")

ALLOWABLE DEFL.(TL) = L/360 (0.20")

CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (max:0), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(ORY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 818 354 1607 789 1887 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) INPUT = 0.90

JSI METAL = 0.09 (B) INPUT = 1.00

LICENSED PROFESSIONAL ENGINEER

24/10/20

H. J. G. ALVES


100009024

PROVINCE OF ONTARIO

Structural component only

DWG# T-2007648

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C41	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:44 2020 Page 1					
ID:DMCubINVR6TsiF0e31v6l zns11-LM MNT0?iyHq7dfv0e7UaEx3uJnoyDCMnNgqYzME7z					
5-10-8					

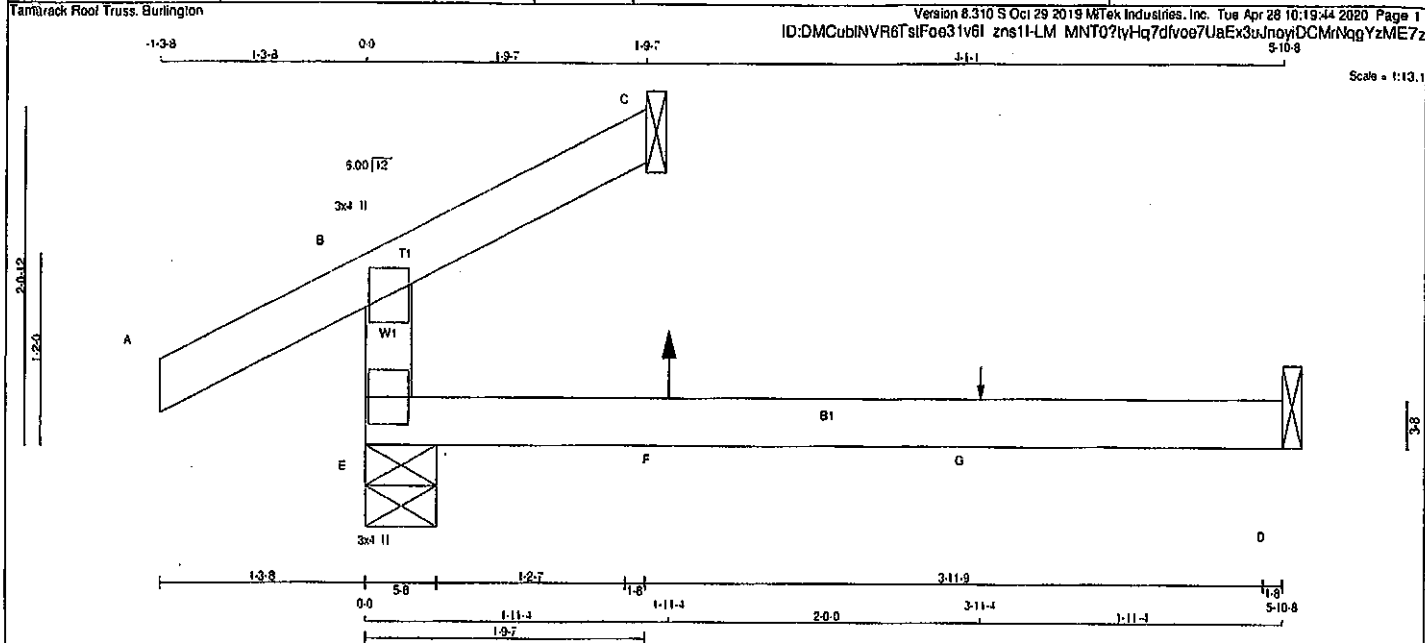

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMV+p	MT20	3.0	4.0	
E 9MV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED	MAXIMUM FACTORED		INPUT	REQD		
	GROSS REACTION	GROSS REACTION		BRG	BRG		
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	284	0	284	0	5-8	5-8	
C	83	0	83	0	1-8	1-8	
D	44	0	52	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) E, D

UNFACTORED REACTIONS							
JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	200	137	0	0	0	82	0
C	48	21	0	0	0	25	0
D	35	0	3	0	0	37	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (7)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED		MEMB.	MAX. FACTORED		
	FORCE	VERT. LOAD	LC1 MAX		FORCE	MAX	
	(LBS)	(PLF)	CSI (LC)		(LBS)	CSI (LC)	
FR-TO		FROM TO	UNBRAC	FR-TO			
E-B	-227	0	0.0 0.0 0.11 (4)	7.81			
A-B	0	28	-91.8 -91.8 0.12 (1)	10.00			
B-C	-9	9	-91.8 -91.8 0.08 (4)	10.00			
E-F	0	0	-18.5 -18.5 0.14 (4)	10.00			
F-G	0	0	-18.5 -18.5 0.14 (4)	10.00			
G-D	0	0	-18.5 -18.5 0.14 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL
F	1-11-4	7	1	12	BACK	VERT	TOTAL
G	3-11-4	1	1	---	BACK	VERT	TOTAL

CONNECTION REQUIREMENTS

II C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. O.C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

SS % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.04")

CSI: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4), WB=0.00/1.00 (A-D:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP (DRY) SHEAR	SECTION		
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618	354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.80)
JSI METAL = 0.06 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007649

JOB NAME 408224	TRUSS NAME C42	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamirack Roof Truss, Burlington

Version 8.310.5 Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:45 2020 Page 1

ID:DMCubINVR6TsF0e31v6I zns11-pYYkap1eeGPhnE6LLeJ7RUC2j9wh9SMbV7NC zME7y

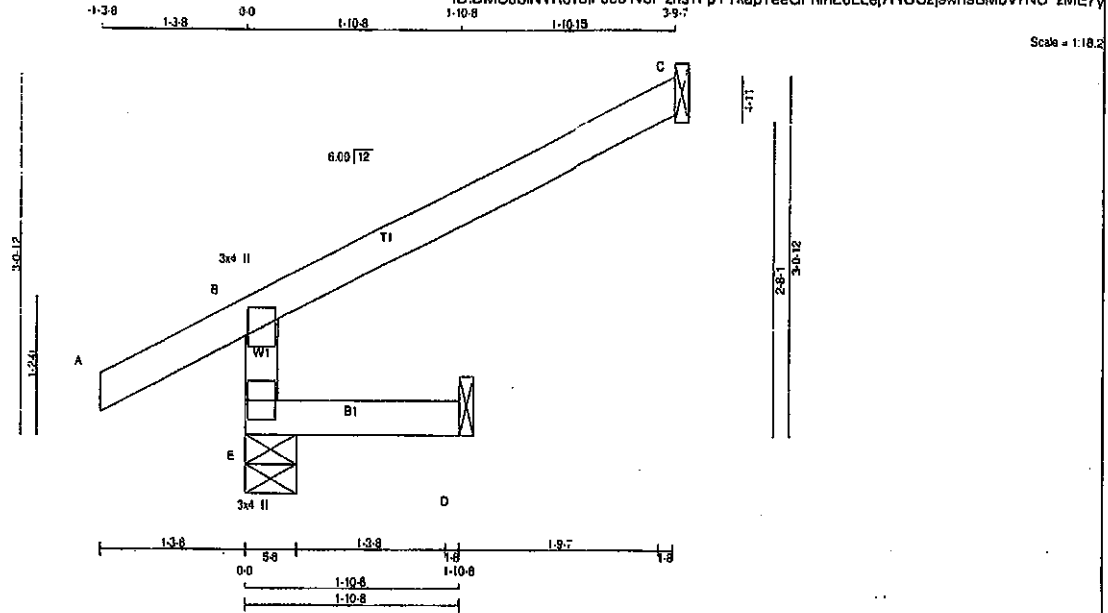

TOTAL WEIGHT = 3 X 10 = 29 lb

LUMBER	CHORDS	SIZE	DRY	LUMBER	No.2
E - B	2x4	DRY	No.2		
A - C	2x4	DRY	No.2		
E - D	2x4	DRY	No.2		

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	361	0	361	0	5-8	5-8
C	130	0	130	0	1-8	1-8
D	18	0	17	0	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINTS C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	250	190	0	0	0	0	60	0
C	90	73	0	0	0	0	17	0
D	12	0	0	0	0	0	12	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX CSII(LC)	MAX. UNBRACED LENGTH	MEMB. FR-TO	MAX. FACTORED FORCE (LBS)	MAX CSII(LC)
FR-TO		FROM TO						
E-B	-342 0	0.0 0.0		0.01 (4)	7.81			
A-B	0 28	-91.8 -91.8		0.13 (5)	10.00			
B-C	-19 0	-91.8 -91.8		0.22 (1)	6.25			
E-D	0 0	-18.5 -18.5		0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.22(1.00 (B-C:1), BC=0.02(1.00 (D-E:4), WB=0.00(1.00 (max:0), SSI=0.15(1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	818	354
MT20	1687	788
MT20	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (E) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007650

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C43	3	1	GREEN PARK HOMES	
TRUSS DESC.					

Tantrac Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:46 2020 Page 1
ID:DMCubINVR6TstFoe31v6l zns11-lk66o92GPaXYNxpIv39yff1OQ6VqQciVq9sxlRzME7x

Scale = 1/16.1

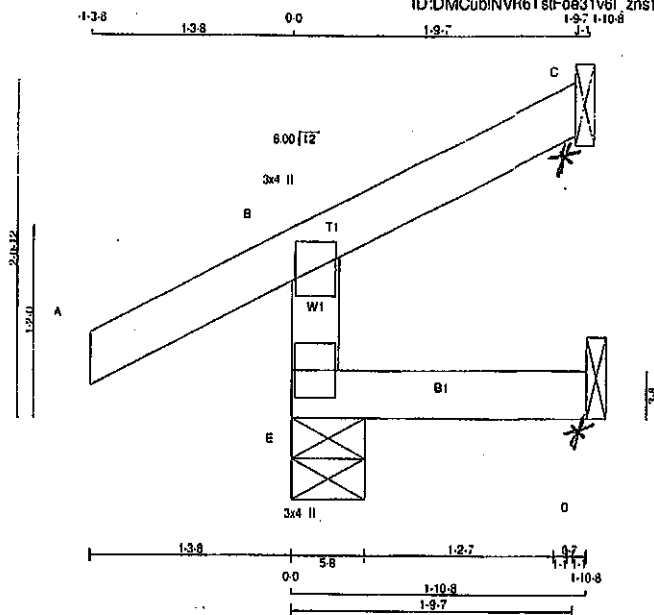

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
E	271	0	271	0
C	45	0	45	0
D	8	0	17	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	186	141	0	0	0	47	0
C	31	24	-18	0	0	7	0
D	7	0	-8	0	0	12	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC)	
FR-TO		FROM	TO	FR-TO		FROM	TO
E-B	-244	0	0.0	0.0	0.04	(5)	7.81
A-B	0	28	-91.8	-91.8	0.12	(1)	10.00
B-C	-17	0	-91.8	-91.8	0.09	(1)	6.25
E-D	0	0	-18.5	-18.5	0.04	(5)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD				= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5)
WB=0.00/1.00 (A-B:0), SS=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	618	354
	1667	788
	1967	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.07 (8) (INPUT = 1.00)




Structural component only
DWG# T-2007651

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	C44	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:47 2020 Page 1

ID:DMCubINVR6TsFos31v6I ,zns11-mxgU7V3uAtfP 5OUTmh8CsZXYWqD93ye2pcUHizME7w

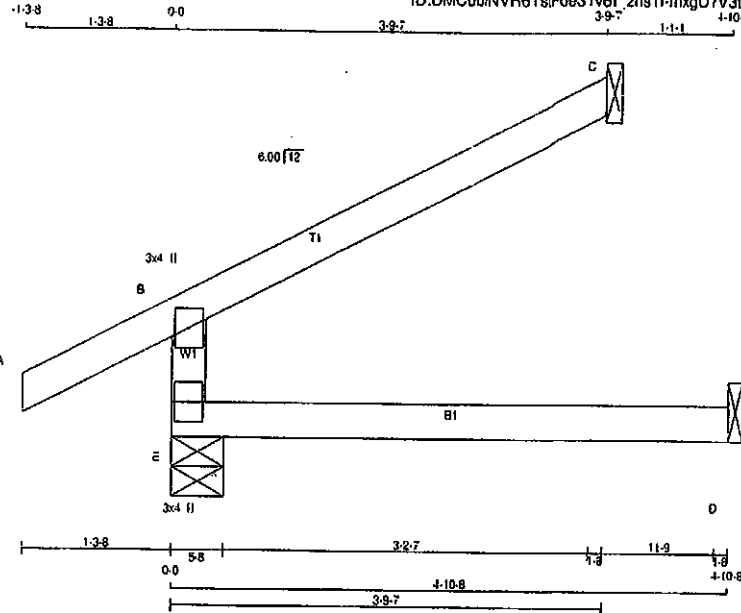

Scale = 1:17.9

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	
E - B	2x4	DRY	No.2	
A - C	2x4	DRY	No.2	
E - D	2x4	DRY	No.2	
DRY: SEASONED LUMBER.				

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING DESIGNER												
BEARINGS												
		FACTORED		MAXIMUM FACTORED		INPUT		REQRD				
		GROSS REACTION		GROSS REACTION		BRG		BRG				
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX			IN-SX		
E		394	0	394	0	0	5-8			5-8		
C		130	0	130	0	0	1-8			1-8		
D		38	0	42	0	0	1-8			1-8		

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	COMBINED	SNOW		LIVE		PERM.LIVE		WIND	DEAD	SOIL
		1ST LCASE	MAX. MIN.	1ST LCASE	MAX. MIN.	1ST LCASE	MAX. MIN.			
E	277	190	0	0	0	0	0	0	0	0
C	90	73	0	0	0	0	0	0	17	0
D	30	0	0	0	0	0	0	0	30	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX CS1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)	
FR-TO		FROM TO				FR-TO			
E-B	-342 0	0.0	0.0	0.08 (4)	7.81				
A-B	0 28	-91.8	-91.8	0.12 (1)	10.00				
B-C	-19 0	-91.8	-91.8	0.22 (1)	8.25				
E-D	0 0	-18.5	-18.5	0.09 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.02")

CSI: TC=0.22;1.00 (B-C:1), BC=0.09;1.00 (D-E:4), WB=0.09;1.00 (max0), SS=0.15;1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1867 788	1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007652

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C45	2	1	GREEN PARK HOMES	
Tandem Rack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:48 2020 Page 1

ID:DMCubINVR6TslFoe31v6l_zns1l-E7DsCr3WxBnFcFyg1UCQ46kwwAMuWC0HTL1pJzME7v

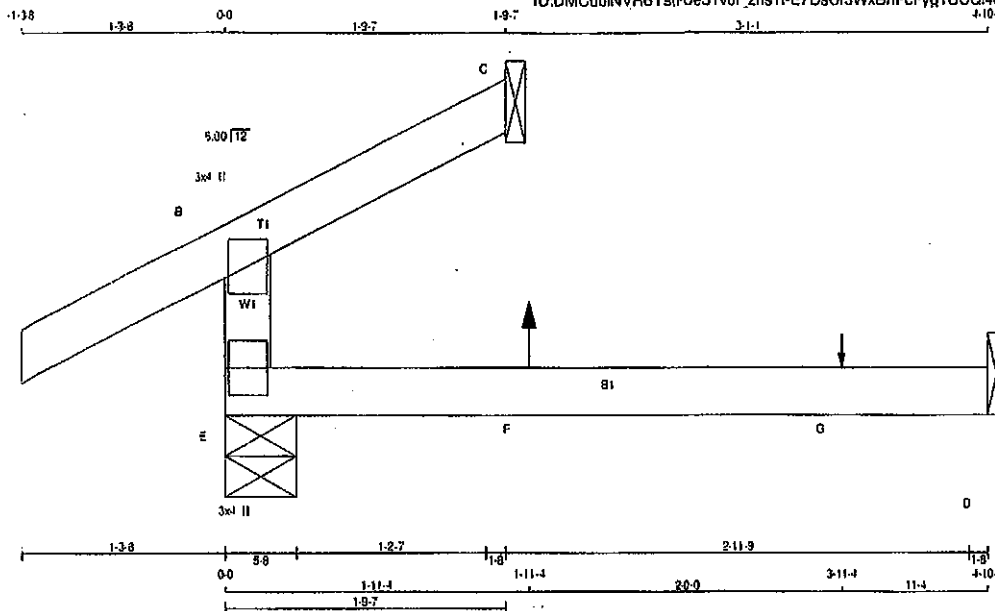

Scale = 1:13.1

TOTAL WEIGHT = 2 X 10 = 21 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.	SPF
E - B	2x4	DRY	No.2				
A - C	2x4	DRY	No.2				
E - D	2x4	DRY	No.2				

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0			
E	BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
E	282	0	282	0	5.8
C	55	0	55	0	1.8
D	35	0	44	0	1.8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) E, C

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	198	137	0	0	0	61	0
C	39	21	0	0	0	18	0
D	29	0	4	0	0	31	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (7)

CHORDS			WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LO1 MAX CS1 (LC)	MAX. UNBRAC LENGTH	MEMB. FR-TO	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)
FR-TO		FROM TO					
E-B	-235 0	0.0 0.0	0.07 (4)	7.81			
A-B	0 28	-91.8 -91.8	0.12 (1)	10.00			
B-C	-13 5	-91.8 -91.8	0.07 (5)	6.25			
E-F	0 0	-18.5 -18.5	0.10 (4)	10.00			
F-G	0 0	-18.5 -18.5	0.10 (4)	10.00			
G-D	0 0	-18.5 -18.5	0.10 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11.4	7	1	12	BACK	VERT	TOTAL	...	C1
G	3-11.4	1	1	...	BACK	VERT	TOTAL	...	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.12/1.00 (A-B:1), BC=0.10/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SS=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1907 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.10 (E) INPUT = 0.90
JSI METAL = 0.07 (B) INPUT = 1.00



Structural component only
DWG# T-2007653

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C46	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 26 10:19:49 2020 Page 1	

ID:DMCubINVR6TslFoe31v6I zns11-iJnEQB48hUv6EPXlaBjIHfukKVjdZsXW75bLizME7u

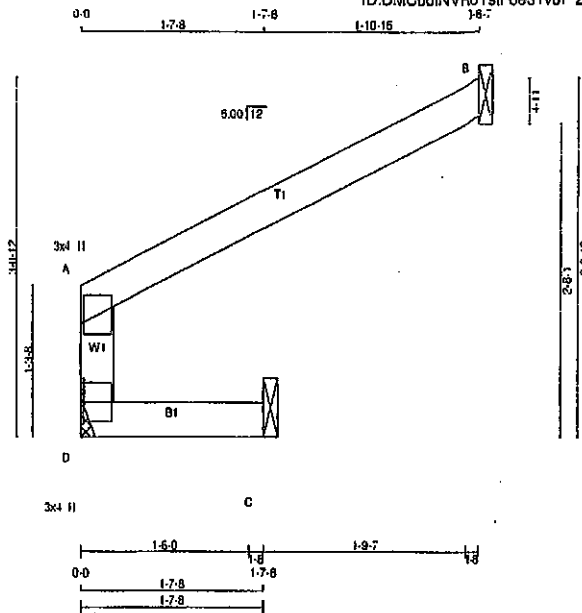

Scale = 1/16"

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
O - A	2x4	DRY	No.2
A - B	2x4	DRY	No.2
D - C	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMV+p	MT20	3.0	4.0
D	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
D	156	0	156	0	0
B	144	0	144	0	0
C	55	0	55	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS		1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
D	109	78	0
B	99	80	0
C	40	23	0

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1	MAX. (PLF)	MEMB.	FORCE (LBS)
FR-TO				FR-TO	
D-A	-181	0	0.0	0.0	0.08 (1)
A-B	-8	0	-91.8	-91.8	0.14 (1)
D-C	0	0	-18.5	-18.5	0.09 (1)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2010
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (A-B:1), BC=0.09/1.00 (C-D:1), WB=0.00/1.00 (max:0), SSI=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 819 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.08 (D) (INPUT = 0.90)
JSI METAL = 0.05 (A) (INPUT = 1.00)




Structural component only
DWG# T-2007654

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C47	1	1	GREEN PARK HOMES	
Farmareck Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 \$ Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:19:50 2020 Page 1

ID:DMCubINVR6TsIFos31v8I znsII-AWLddX5mSo12rY838uEuqVB5ske7MQI5knc8uCzME7

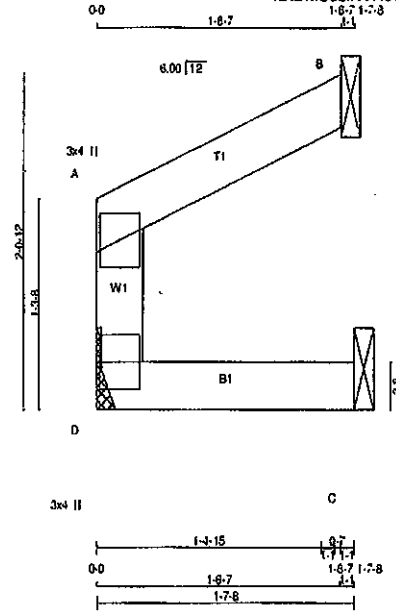

Scale = 1:13.1

TOTAL WEIGHT = 5 lb (M/F)

LUMBER				DESCR.	
N.L.G.A. RULES	SIZE	LUMBER		SPF	
CHORDS					
D - A	2x4	DRY	No.2	SPF	
A - B	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	

DRY, SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMV+p	MT20	3.0	1.0	
D	BMV+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	VERT	GROSS	REACT	GROSS	REACT	BRG	8RG	BRG	8RG
D	86	0	86	0	0	MECHANICAL			
B	67	0	67	0	0	1-8	1-8		
C	19	0	19	0	0	1-8	1-8		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINTS) B . C

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
D	61	39 0	0 0	0 0	0 0
B	46	37 0	0 0	0 0	0 0
C	14	2 0	0 0	0 0	0 0

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD (PL)	MAX. (LC)	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
D-A	-74 0	0.0	0.0 0.01 (1)	7.61	
A-B	-2 0	-91.8	-91.8 0.03 (1)	10.00	
D-C	0 0	-18.5	-18.5 0.01 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF B0BC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.03, 1.00 (A-B:1), BC=0.01, 1.00 (C-D:4), WB=0.00, 1.00 (in a:0), SSI=0.05, 1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.03 (D) (INPUT = 0.90)
JSI METAL= 0.02 (A) (INPUT = 1.00)



Structural component only
DWG# T-2007655

LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:

- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options Information on p. 126.




Double-Shear
Nailing
Top View




Double-Shear
Nailing
Side View;
Do not
bend tab




Dome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,580

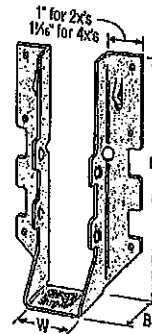


✓ LUS28




LU26L

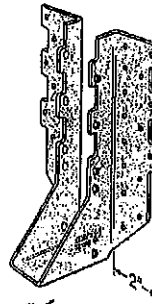

✓ HUS210
(HUS26, HUS28,
and HHUS similar)





✓ HGUS28-2



✓ HHUS210-2

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

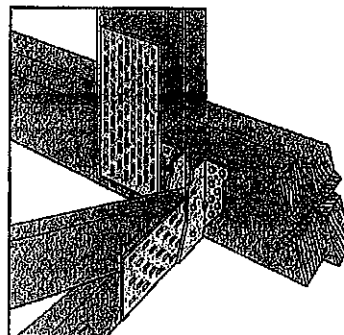

LJS26DS

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options Information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value

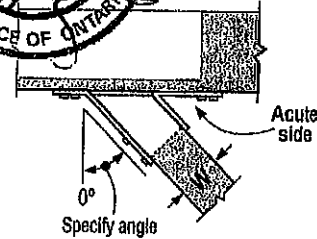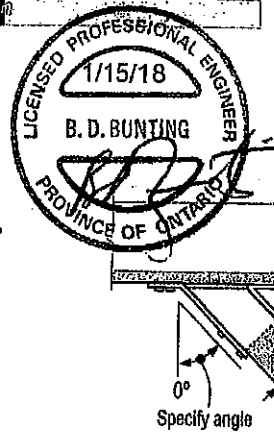

**Top View HHUS Hanger
Skewed Right**
(joist must be bevel cut)
All joist nails installed on the
outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive[®] SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ³	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
								lb.	lb.	lb.	lb.
								kN	kN	kN	kN
Single 2x Sizes											
LUS24	18	1 1/8	3 1/4	1 1/4	2 1/4	(4) 10d	(2) 10d	710	1625	645	1155
								3.16	7.23	2.87	5.14
LU24L	22	1 1/8	3	1 1/4	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360	1020	320	726
								1.60	4.54	1.42	3.22
LU26L	22	1 1/8	5	1 1/4	4 1/4	(6) 10d	(4) 10d x 1 1/2"	720	1605	645	1140
								3.20	7.14	2.87	5.07
LUS26	18	1 1/8	4 1/4	1 1/4	3 1/4	(4) 10d	(4) 10d	1420	2170	1290	1630
								6.32	9.85	5.74	7.25
HUS26	18	1 1/8	5 1/4	3	3 1/8	(14) 10d	(6) 16d	2705	4940	2065	3875
								11.30	21.97	9.20	17.24
LJS28DS	18	1 1/8	5	3 1/4	4 1/4	(16) 16d	(6) 16d	2055	4265	1460	4115
								9.14	18.97	6.49	18.31
HGUS28	12	1 1/8	5 1/4	5	4 1/4	(20) 18d	(8) 16d	2885	6625	2685	5700
								11.96	29.51	11.96	25.35
LU28L	20	1 1/8	6 1/4	1 1/4	5 1/4	(8) 10d	(8) 10d x 1 1/2"	1140	2185	1020	1550
								5.07	9.72	4.54	6.89
LUS28	18	1 1/8	6 1/4	1 1/4	3 1/4	(6) 10d	(4) 10d	1420	2520	1290	1790
								6.32	11.21	5.74	7.96
HUS28	16	1 1/8	7 1/4	3	6 1/8	(22) 18d	(8) 16d	3605	5365	2675	4345
								16.04	23.88	11.90	19.33
HGUS28	12	1 1/8	7 1/4	5	6 1/4	(36) 18d	(12) 16d	3310	7675	3310	6900
								14.74	34.19	14.74	30.73
LU210L	20	1 1/8	8	1 1/4	7 1/4	(10) 10d	(8) 10d x 1 1/2"	1140	2495	1020	1770
								5.07	11.10	4.54	7.87
LUS210	18	1 1/8	7 1/4	1 1/4	3 1/4	(8) 10d	(4) 10d	1420	2785	1290	2210
								6.32	12.39	5.74	9.83

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.182" dia. x 3 1/4" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers


SIMPSON

Strong-Tie

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _a ¹	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb.	(K _D = 1.00) lb.	(K _D = 1.15) lb.	(K _D = 1.00) lb.
								kN	kN	kN	kN
Double 2x Sizes											
LUS24-2	18	3 1/4	3 1/4	2	1 1/2	(4) 16d	(2) 16d	835 3.71	2020 8.99	590 2.62	1435 6.38
LUS26-2	18	3 1/4	4 1/4	2	4	(4) 16d	(4) 16d	1720 7.65	2595 11.54	1545 6.87	1920 8.54
HHUS26-2	14	3 1/4	5 1/4	3	3 1/4	(14) 16d	(6) 16d	2850 12.68	7335 32.83	2065 9.20	5205 23.15
HGUS26-2	12	3 1/4	5 1/4	4	4 1/4	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
LUS28-2	18	3 1/4	7	2	4	(6) 16d	(4) 16d	1720 7.65	3325 14.79	1545 6.87	2575 11.45
HHUS28-2	14	3 1/4	7 1/4	3	6 1/4	(22) 16d	(8) 16d	3765 16.75	8940 39.77	2675 11.90	6345 28.22
HGUS28-2	12	3 1/4	7 1/4	4	6 1/4	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
LUS210-2	18	3 1/4	9	2	6	(8) 16d	(6) 16d	2580 11.48	4500 20.02	2320 10.32	3195 14.21
HHUS210-2	14	3 1/4	9 1/4	3	8	(30) 16d	(10) 16d	4670 20.77	9660 42.97	4235 18.84	7000 31.14
HGUS210-2	12	3 1/4	9 1/4	4	8 1/4	(46) 16d	(16) 16d	6840 30.43	14015 62.34	4855 21.60	10270 45.69
Triple 2x Sizes											
HGUS26-3	12	4 1/4	5 1/2	4	4 1/4	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
HGUS28-3	12	4 1/4	7 1/4	4	6 1/4	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
HHUS210-3	14	4 1/4	9	3	7 1/4	(30) 16d	(10) 16d	4670 20.77	9670 43.02	4235 18.84	6855 30.54
HGUS210-3	12	4 1/4	9 1/4	4	8 1/4	(46) 16d	(16) 16d	6840 30.43	14645 65.14	4855 21.60	10400 46.26
Quadruple 2x Sizes											
HGUS26-4	12	6 1/4	5 1/4	4	4 1/4	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
HGUS28-4	12	6 1/4	7 1/4	4	6 1/4	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
HHUS210-4	14	6 1/4	9	3	7 1/4	(30) 16d	(10) 16d	4670 20.77	10155 45.17	4235 18.84	7210 32.07
HGUS210-4	12	6 1/4	9 1/4	4	8 1/4	(46) 16d	(16) 16d	6840 30.43	14645 65.14	4855 21.60	10400 46.26
HGUS212-4	12	6 1/4	10 1/4	4	10 1/4	(50) 16d	(20) 16d	7640 33.98	14995 66.70	5425 24.13	10845 47.35
HGUS214-4	12	6 1/4	12 1/4	4	11 1/4	(66) 16d	(22) 16d	10130 45.06	16400 72.95	7195 32.00	11645 51.80
4x Sizes											
LUS46	18	3 1/4	4 1/4	2	3 1/4	(4) 16d	(4) 16d	1720 7.65	2595 11.54	1545 6.87	1920 8.54
HHUS46	14	3 1/4	5 1/4	3	3 1/4	(14) 16d	(6) 16d	2540 11.30	7335 32.83	2065 9.20	5205 23.15
HGUS46	12	3 1/4	5 1/4	4	4 1/4	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
LUS48	18	3 1/4	6 1/4	2	3 1/4	(8) 16d	(4) 16d	1720 7.65	3325 14.79	1545 6.87	2575 11.45
HHUS48	14	3 1/4	7 1/4	3	6 1/4	(22) 16d	(8) 16d	3765 16.75	8940 39.77	2675 11.90	6345 28.22
HGUS48	12	3 1/4	7 1/4	4	6 1/4	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
LUS410	18	3 1/4	8 1/4	2	5 1/4	(8) 16d	(6) 16d	2580 11.48	4500 20.02	2320 10.32	3195 14.21
HGUS410	12	3 1/4	9	4	8 1/4	(46) 16d	(16) 16d	6840 30.43	14015 62.34	4855 21.60	10270 45.69
HGUS412	12	3 1/4	10 1/4	4	10 1/4	(56) 16d	(20) 16d	7640 33.98	14995 66.70	5425 24.13	10845 47.35
HGUS414	12	3 1/4	12 1/4	4	11 1/4	(66) 16d	(22) 16d	10130 45.06	16400 72.95	7195 32.00	11645 51.80



Plated Truss Connectors

See footnotes
on p. 268.

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

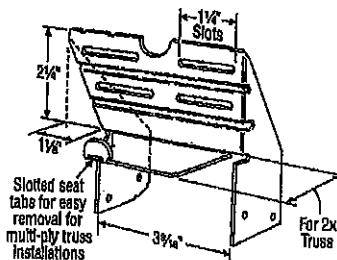


TC24
U.S. Patent 4,932,173

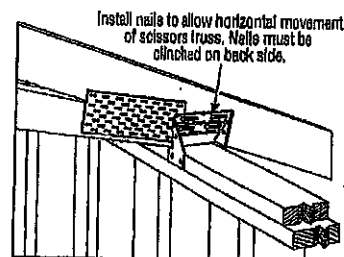


Typical TC24 Installation

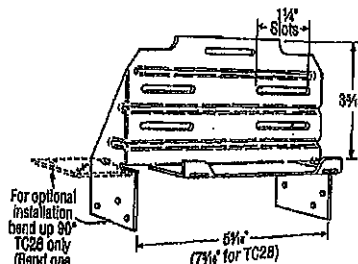

TC25
(TC28 Similar)

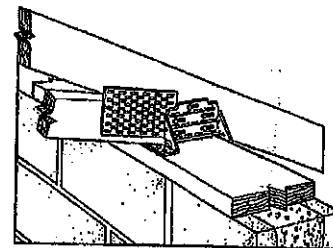

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer (8", 10", 12" Wall Installation Similar)

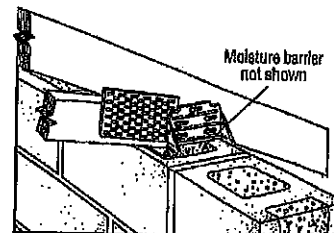

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K ₀ =1.15)	Uplift (K ₀ =1.15)
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K ₀ =1.15)	Uplift (K ₀ =1.15)
TC26	(5) 10d	(8) 10d x 1 1/2"	810	660
	(5) 10d	(8) 10d	930	680

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.
4. TC26 fastened to grouted concrete block with (8) - 9/16" x 2 1/4" Titen screws has a factored uplift resistance of 276 lb.



DESIGN

DESIGN

DESIGN

DESIGN

DESIGN

DESIGN

DESIGN

DESIGN

(800) 999-5099
strongtie.com

H/TSP

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance (K _p = 1.15)					
					D.Fir-L			S-P-F		
		To Rafter/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(6) 8d x 1½"	(4) 8d	—	740	685	300	680	485	215
					3.29	3.05	1.33	3.02	2.16	0.96
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
					3.58	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	265	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ^a	18	(5) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A ^a	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1605	585	290
					7.72	3.54	1.82	6.69	2.61	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^{a,b}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1465	795	315	1040	585	225
					6.52	3.54	1.40	4.63	2.61	1.00
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
		[2] (12) 8d x 1½"	(15) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
TSP	16	(9) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
					5.76	1.98	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.98	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCMR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.162" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry ($< 19\%$ moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

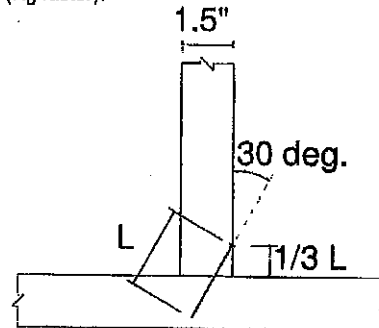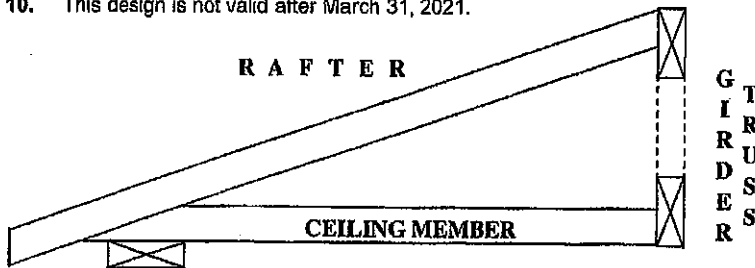

TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (In)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37679H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

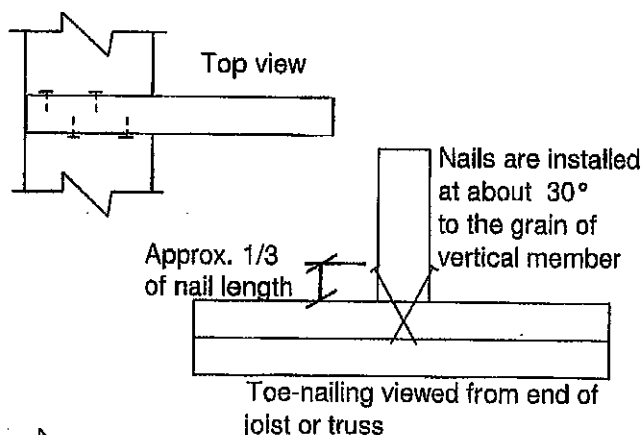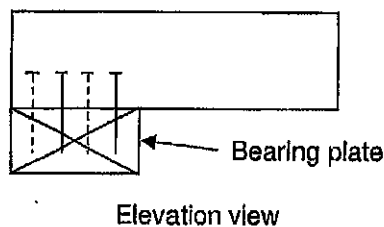

Toe-nailing on 2x4 Bearing Plate

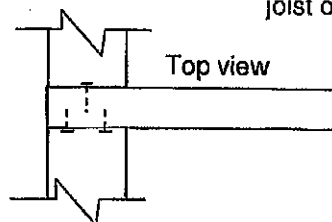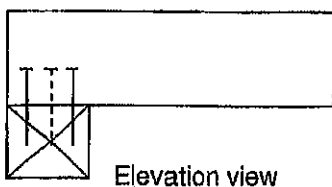


MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint, unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/8" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

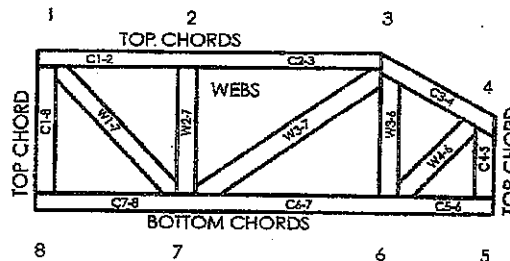

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MIT-7473C rev. 10-DB

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See 8CSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane of joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected ovetop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

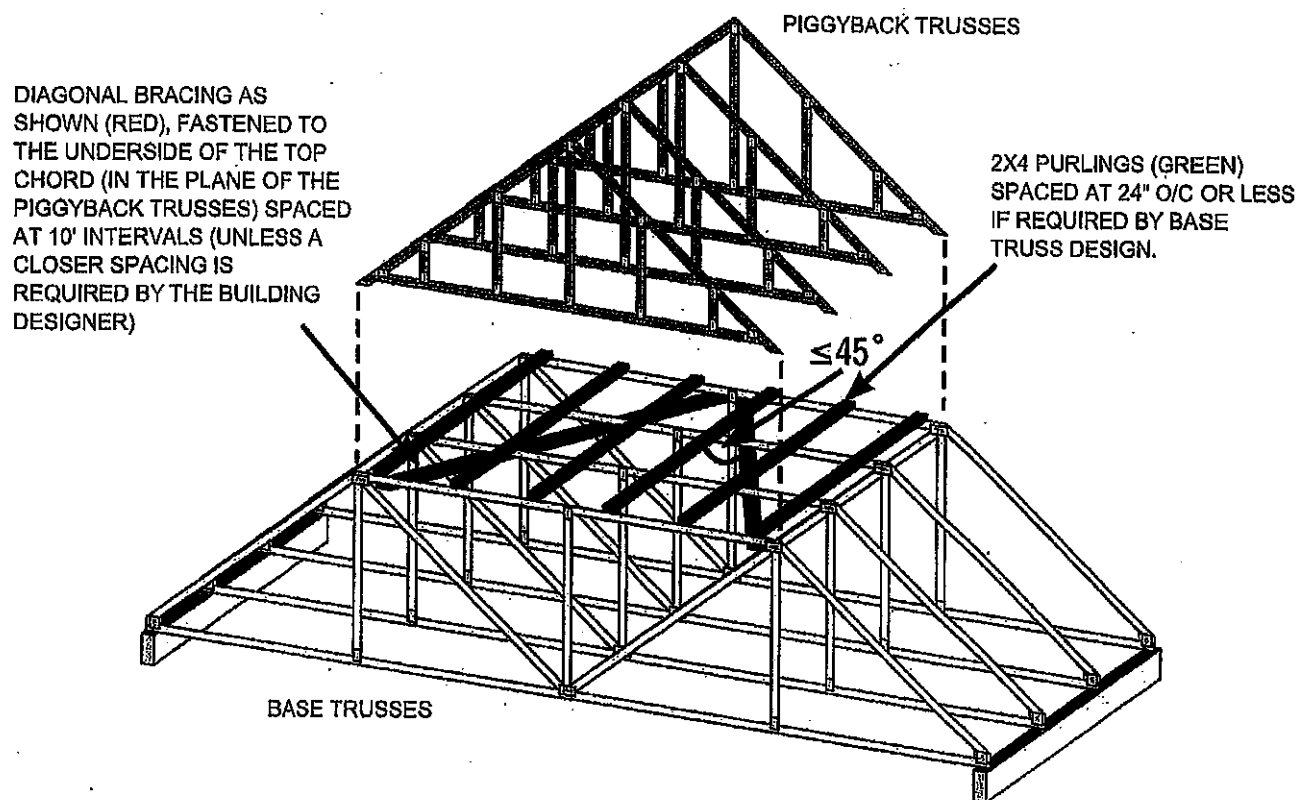


NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufacturer's responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1800213

Feb 09, 2018