


 TAMARACK ROOF TRUSSES INC. ALFA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 5 Lot #: 185 Elevation: 1- STD OR OPT.5 BR	Job Track: 51225 PlanLog: 202406 Layout ID: 408168 Ref # Page: 1 of 2 Date: 04-27-2020 Designer: Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	10 / 12	35-02-00	4-01-11	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	385.29 218.00		
	1 2-ply	T1Z Hip Girder	10 / 12	35-02-00	4-01-11	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	385.29 218.00		
	2	T2 Hip	10 / 12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	293.44 186.67		
	2	T3 Hip	10 / 12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	296.43 188.67		
	2	T4 Hip	10 / 12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	323.09 204.33		
	2	T5 Hip	10 / 12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	326.19 204.87		
	2	T6 Hip	10 / 12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	363.03 228.67		
	5	T7 Hip	10 / 12	35-02-00	10-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	886.8 540.00		
	2	T8 Hip	10 / 12	35-02-00	11-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	380.38 236.67		
	6	T9 Common	10 / 12	16-03-00	8-04-15	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	480.82 308.00		
	1	G9 GABLE	10 / 12	16-03-00	8-04-15	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	81.49 53.33		
	1	T10 Common	10 / 12	8-02-00	5-00-08	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	38.47 25.83		
	1	G10 GABLE	10 / 12	8-02-00	5-00-08	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	40.07 27.83		
	3	T11 Common	10 / 12	13-05-00	7-02-12	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	191.27 120.50		

 TAMARACK ROOF TRUSSES INC. ALFA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 5 Lot #: 185 Elevation: 1- STD OR OPT.5 BR	Job Track: 51225 PlanLog: 202406 Layout ID: 408168 Ref # Page: 2 of 2 Date: 04-27-2020 Designer: Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	G11 GABLE	10 / 12	13-05-00	7-02-12	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	65.46 42.17		
	1	T12 Hip Girder	10 / 12	8-02-00	2-02-08	2 x 4	1-03-08 1-03-08	1-00-07 1-00-07	34.43 25.33		
	1	T13 Half Hip Girder	10 / 12	7-07-00	2-02-08	2 x 4	1-03-08	1-00-07 1-09-07	31.77 22.50		
	3	PB1 Piggyback	10 / 12	14-10-03	2-00-00	2 x 4			135.57 90.00		
	19	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	319.1 202.67		
	8	J2 Jack-Open	4 / 12	4-04-08	2-02-06	2 x 4	1-03-08	3-15 1-09-07	95.29 64.00		

TOTAL # TRUSS= 66 TOTAL BFT OF ALL TRUSSES= 3206.84 BFT. TOTAL WEIGHT OF ALL TRSSES 5093.55 LBS


HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS28-2	
6	Hardware	LJS28DS	
1	Hardware	LUS28-2	

TOTAL NUMBER OF
ITEMS= 7

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T1	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 5 Oct 2019 Mitek Industries, Inc. Sat Apr 25 12:34:48 2020 Page 1
ID:DMCubINVR6TstFoe31v8l_zns1l-Mcnic2FIKlqQuZwGH_IYq9JSt_3Jk34wGOWeSzNBPRL

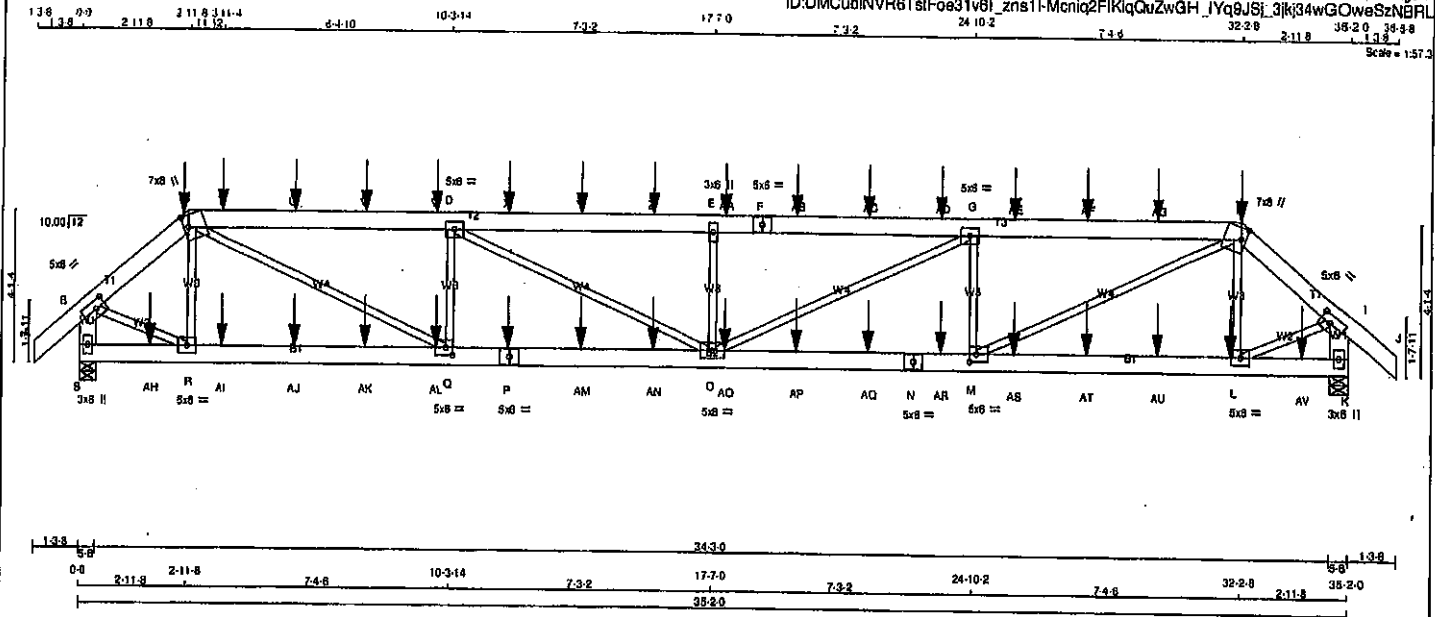

TOTAL WEIGHT = 2 X 183 = 366 lb

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x8	DRY	No.2	SPF	
C - F	2x8	DRY	No.2	SPF	
F - H	2x8	DRY	No.2	SPF	
H - J	2x8	DRY	No.2	SPF	
J - L	2x8	DRY	No.2	SPF	
L - N	2x8	DRY	No.2	SPF	
N - K	2x8	DRY	No.2	SPF	
P - N	2x8	DRY	2100F 1.8E	SPF	
N - K	2x8	DRY	2100F 1.8E	SPF	

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 2 12	SIDE(122.0)	
C - F 2 12	SIDE(81.0)	
F - H 2 12	SIDE(81.0)	
H - J 2 12	SIDE(122.0)	
J - L 2 12	TOP	
L - N 2 12	TOP	
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S - P 2 12	SIDE(0.0)	
P - N 2 12	SIDE(0.0)	
N - K 2 12	SIDE(197.8)	
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT 3330	0	0	5-8
S	HORZ 3379	0	0	5-8
K	UPLIFT 3379	0	0	5-8

UNFACTORED REACTIONS

1ST LOASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	COMBINED	2354	1553 / 0	0 / 0	0 / 0	801 / 0	0 / 0
S		2388	1572 / 0	0 / 0	0 / 0	816 / 0	0 / 0
K							

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.98 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO					FR-TO			
A-B	0 / 42	-91.8	-91.8 0.04 (1)	10.00	R-C	-850 / 0	0.08 (1)	10.00
B-C	-3387 / 0	-91.8	-91.8 0.05 (1)	6.82	C-Q	0 / 4509	0.58 (1)	10.00
C-T	-6602 / 0	-91.8	-91.8 0.38 (1)	4.31	Q-D	-1798 / 0	0.22 (1)	10.00
T-U	-6602 / 0	-91.8	-91.8 0.38 (1)	4.31	D-O	0 / 1370	0.17 (1)	10.00
U-V	-6602 / 0	-91.8	-91.8 0.38 (1)	4.31	O-E	-897 / 0	0.12 (1)	10.00
V-W	-6602 / 0	-91.8	-91.8 0.38 (1)	4.31	E-G	0 / 1382	0.17 (1)	10.00
W-D	-6602 / 0	-91.8	-91.8 0.38 (1)	4.31	M-G	-1787 / 0	0.21 (1)	10.00
D-X	-7828 / 0	-91.8	-91.8 0.42 (1)	3.98	M-H	0 / 4481	0.65 (1)	10.00
X-Y	-7828 / 0	-91.8	-91.8 0.42 (1)	3.98	L-H	-881 / 0	0.08 (1)	10.00
Y-Z	-7828 / 0	-91.8	-91.8 0.42 (1)	3.98	B-R	0 / 2736	0.34 (1)	10.00
Z-E	-7828 / 0	-91.8	-91.8 0.42 (1)	3.98	L-I	0 / 2771	0.34 (1)	10.00
E-AA	-7828 / 0	-91.8	-91.8 0.42 (1)	3.98				
AA-F	-7828 / 0	-91.8	-91.8 0.42 (1)	3.98				
F-AB	-7828 / 0	-91.8	-91.8 0.42 (1)	3.98				
AB-AC	-7828 / 0	-91.8	-91.8 0.42 (1)	3.98				
AC-AD	-7828 / 0	-91.8	-91.8 0.42 (1)	3.98				
AD-G	-7828 / 0	-91.8	-91.8 0.42 (1)	3.98				
G-AE	-6608 / 0	-91.8	-91.8 0.38 (1)	4.31				
AE-AF	-6608 / 0	-91.8	-91.8 0.38 (1)	4.31				
AF-AG	-6608 / 0	-91.8	-91.8 0.38 (1)	4.31				
AG-H	-6608 / 0	-91.8	-91.8 0.38 (1)	4.31				
H-I	-3410 / 0	-91.8	-91.8 0.05 (1)	8.00				
I-J	0 / 42	-91.8	-91.8 0.04 (1)	10.00				
S-B	-3375 / 0	0.0	0.0 0.12 (1)	7.58				
K-I	-3414 / 0	0.0	0.0 0.12 (1)	7.55				

S-AH	0 / 0	-18.5	-18.5 0.05 (4)	10.00
AH-R	0 / 0	-18.5	-18.5 0.05 (4)	10.00
R-AI	0 / 2553	-18.5	-18.5 0.12 (1)	10.00
AI-AJ	0 / 2553	-18.5	-18.5 0.12 (1)	10.00
AJ-AK	0 / 2553	-18.5	-18.5 0.12 (1)	10.00
AK-AL	0 / 2553	-18.5	-18.5 0.12 (1)	10.00
AL-Q	0 / 2553	-18.5	-18.5 0.12 (1)	10.00
Q-P	0 / 8802	-18.5	-18.5 0.22 (1)	10.00
P-AM	0 / 8802	-18.5	-18.5 0.22 (1)	10.00
AM-AN	0 / 8802	-18.5	-18.5 0.22 (1)	10.00
AN-O	0 / 8802	-18.5	-18.5 0.22 (1)	10.00
O-AQ	0 / 8809	-18.5	-18.5 0.22 (1)	10.00
AQ-AP	0 / 8809	-18.5	-18.5 0.22 (1)	10.00
AP-AQ	0 / 8809	-18.5	-18.5 0.22 (1)	10.00
AQ-N	0 / 8809	-18.5	-18.5 0.22 (1)	10.00
N-AR	0 / 8809	-18.5	-18.5 0.22 (1)	10.00
AR-M	0 / 8809	-18.5	-18.5 0.22 (1)	10.00

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/G

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2010, NBCO 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCO 2010, NBCO 2015, ABC 2019
- PART 9 OF NBCO 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.20")
ALLOWABLE DEFL.(TL) = L/380 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.37")

CSI: TO=0.42/1.00 (D-E:1), BC=0.22/1.00 (C-Q:1),
WB=0.58/1.00 (C-Q:1), SS=0.22/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (H) (INPUT = 0.90)
JSI METAL= 0.65 (N) (INPUT = 1.00)

CONTINUED ON PAGE 2

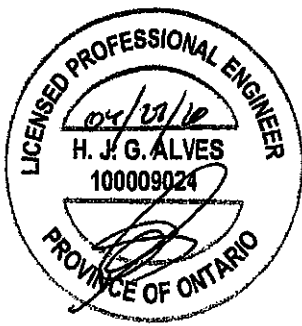

Structural component only
DWG# T-2007129 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T1	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 © Oct 28 2019 MITek Industries, Inc. Sat Apr 25 12:34:48 2020 Page 2
ID:DMCubINVR6TstFoe31v6l zns1l-Monlq2FIKlqQuZwGH 1Yq9JSI 3K434wGOWeSzNBRL

PLATES (table in notes)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-1	MT20	5.0	8.0	2.50	3.25
C	TTWV-m	MT20	7.0	8.0	3.75	1.50
D	TMWV-1	MT20	5.0	8.0		
E	TMWV-w	MT20	3.0	8.0		
F	TS-1	MT20	5.0	8.0		
G	TMWV-1	MT20	6.0	8.0		
H	TTWV-m	MT20	7.0	8.0	3.75	1.50
I	TMWV-1	MT20	5.0	8.0	2.50	3.25
K	BMV1-p	MT20	3.0	8.0		
L	BMWV-1	MT20	5.0	8.0		
M	BMWV-1	MT20	5.0	8.0	2.50	2.25
N	BS-1	MT20	5.0	8.0		
O	BMWV-1	MT20	5.0	8.0		
P	BS-1	MT20	5.0	8.0		
Q	BMWV-1	MT20	5.0	8.0	2.50	2.25
R	BMWV-1	MT20	5.0	8.0		
S	BMV1-p	MT20	3.0	8.0		

LOADING

TOTAL LOAD CASES: 14)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (LBS)	LC1 MAX (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO			FROM	TO	LENGTH	FR-TO	
M-AS	0 / 2588	-18.5	-18.5	0.12 (1)	10.00		
AS-AT	0 / 2588	-18.5	-18.5	0.12 (1)	10.00		
AT-AU	0 / 2588	-18.5	-18.5	0.12 (1)	10.00		
AU-L	0 / 2588	-18.5	-18.5	0.12 (1)	10.00		
L-AV	0 / 0	-18.5	-18.5	0.05 (1)	10.00		
AV-K	0 / 0	-18.5	-18.5	0.05 (1)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-11-3	-38	-42	---	FRONT	VERT	DEAD	---	C1
C	2-11-3	-191	-191	---	FRONT	VERT	SNOW	---	C1
H	32-2-3	-38	-42	---	FRONT	VERT	DEAD	---	C1
H	32-2-3	-118	-118	---	FRONT	VERT	TOTAL	---	C1
H	32-2-3	-191	-191	---	FRONT	VERT	SNOW	---	C1
L	31-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
P	11-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
T	3-11-4	-111	-111	---	FRONT	VERT	TOTAL	---	C1
U	5-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	17-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	19-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	21-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	23-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	25-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	27-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AG	29-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AH	1-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AI	3-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AJ	5-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AK	7-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AL	9-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AM	13-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AN	15-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AO	17-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AP	19-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AQ	21-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AR	23-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AS	25-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AT	27-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AU	29-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AV	33-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007129

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T1Z	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310.3 Oct 29 2019 MTek Industries, Inc. Sat Apr 26 12:34:49 2020 Page 1

ID:DMCubINVR6TstFoe31v6t_zns1l-qoL41NGw50yHWjVSripnNNrbzOlzT47D9w8UBuzNBK

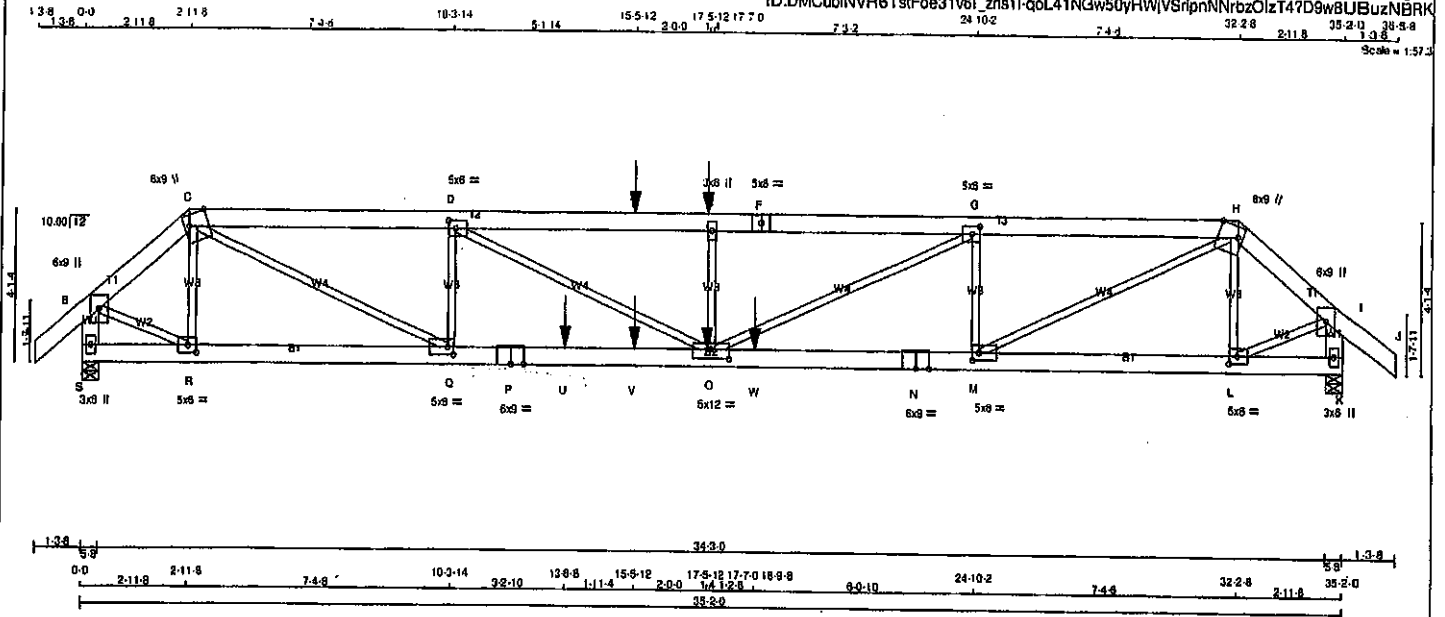

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES	A - C	2x6	DRY	No. 2	SPF
	C - F	2x6	DRY	No. 2	SPF
	F - H	2x6	DRY	No. 2	SPF
	H - J	2x6	DRY	No. 2	SPF
	J - L	2x6	DRY	No. 2	SPF
	L - N	2x6	DRY	No. 2	SPF
	N - K	2x6	DRY	No. 2	SPF
	S - P	2x6	DRY	2100F 1.8E	SPF
	P - N	2x6	DRY	2100F 1.8E	SPF
	N - K	2x6	DRY	2100F 1.8E	SPF
	ALL WEBS EXCEPT	2x3	DRY	No. 2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A - C	2	12
C - F	2	12
F - H	2	12
H - J	2	12
J - L	2	12
L - N	2	12
N - K	2	12
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
S - P	2	12
P - N	2	12
N - K	2	12
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	1	6

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN
S	3963	0	3963
K	3967	0	3967

UNFACTORED REACTIONS

1ST LOASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW
S	2783	1890 / 0
K	2599	1759 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.20 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING TOTAL LOAD CASES: (4)

CHORDS	FACTORED	WEBS	FACTORED
MEMB.	FORCE	VERT. LOAD	MEMB.
(LBS)	(PLF)	LC1	(LBS)
FR-TO	FROM	TO	FR-TO
A-B	0 / 42	-81.8	-81.8
B-C	-3966 / 0	-81.8	-81.8
C-D	-9534 / 0	-81.8	-81.8
D-E	-12331 / 0	-81.8	-81.8
E-F	-12331 / 0	-81.8	-81.8
F-G	-12331 / 0	-81.8	-81.8
G-H	-8575 / 0	-81.8	-81.8
H-I	-3758 / 0	-81.8	-81.8
I-J	0 / 42	-81.8	-81.8
J-K	-3945 / 0	0.0	0.0
K-L	-3733 / 0	0.0	0.0
S-R	0 / 0	-18.5	-18.5
R-Q	0 / 3013	-18.5	-18.5
Q-P	0 / 9534	-18.5	-18.5
P-U	0 / 9534	-18.5	-18.5
U-V	0 / 9534	-18.5	-18.5
V-O	0 / 9534	-18.5	-18.5
O-W	0 / 8575	-18.5	-18.5
W-N	0 / 8575	-18.5	-18.5
N-M	0 / 8575	-18.5	-18.5
M-L	0 / 2844	-18.5	-18.5
L-K	0 / 0	-18.5	-18.5

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	17-5-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
O	17-5-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
T	15-5-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	13-5-8	-1615	-1615	---	BACK	VERT	TOTAL	---	C1
V	15-5-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
W	18-5-8	-1620	-1620	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 183 = 365 b

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17)
CALCULATED VERT. DEFL. (LL) = L/869 (0.35")
ALLOWABLE DEFL. (TL) = L/360 (1.17)
CALCULATED VERT. DEFL. (TL) = L/837 (0.64")

CSI: TC=0.52/1.00 (D-E-I), BC=0.67/1.00 (O-Q-I),
WB=0.90/1.00 (C-Q-I), SS=0.53/1.00 (M-O-I)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1857 788 1857 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (C) (INPUT = 0.90)
JSI METAL = 0.95 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007130 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T1Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:49 2020 Page 2
ID:DMCubINVR6TslFoe31v6I_zns1I-qoL41NGw50yHWVSRgnNNrbzOizT47D8w8UBuzNBRK


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	6.0	9.0		
C	TTWW+m	MT20	8.0	9.0	Edge	6.50
D	TMVW-l	MT20	5.0	6.0	2.50	2.50
E	TMVW+w	MT20	3.0	6.0		
F	TS-l	MT20	5.0	6.0		
G	TMVW-l	MT20	5.0	6.0	2.50	2.50
H	TTWW+m	MT20	8.0	9.0	Edge	6.50
I	TMVW+p	MT20	6.0	9.0		
K	BMV1+p	MT20	3.0	6.0		
L	BMVW-l	MT20	5.0	6.0	2.50	2.75
M	BMVW-l	MT20	5.0	6.0	2.50	2.00
N	BS-l	MT20	6.0	9.0		
O	BMVW-l	MT20	5.0	12.0	3.00	6.00
P	BS-l	MT20	6.0	9.0		
Q	BMVW-l	MT20	5.0	6.0	2.50	2.00
R	BMVW-l	MT20	6.0	6.0	2.50	2.75
S	BMV1+p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2007130 92

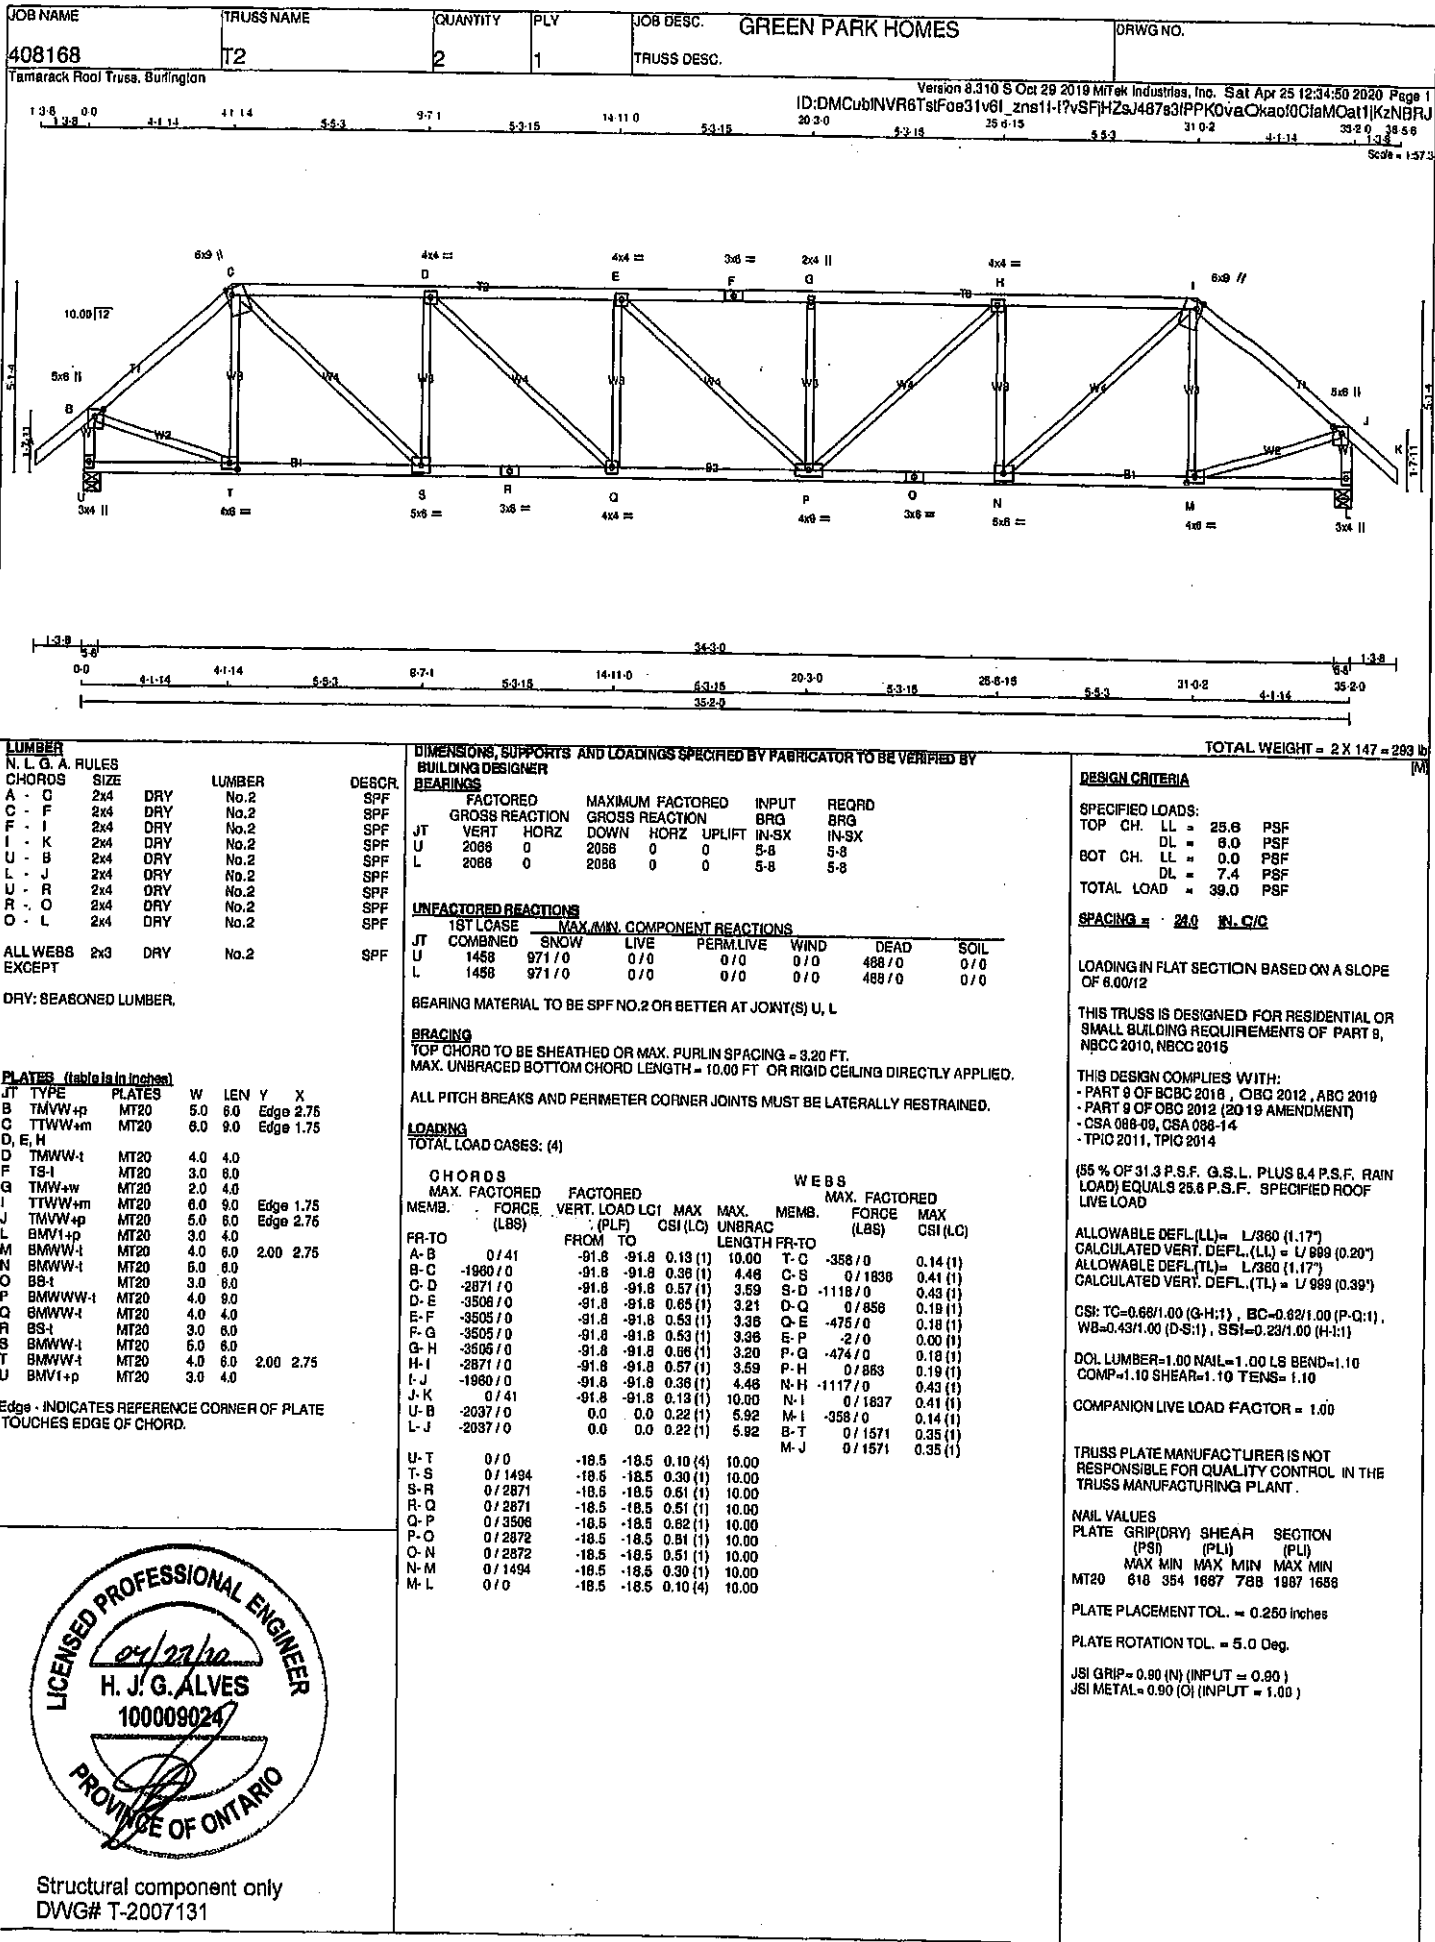

JOB NAME 408168	TRUSS NAME T3	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 9 Oct 2019 Mitek Industries, Inc. Sat Apr 25 12:34:51 2020 Page 1	
				ID:DMCubINVR6TatFos31v6I_zns11-mBTrS3IBddC7IDery7rFSoxJC1Ex4wWcEdaFnzNBRI	

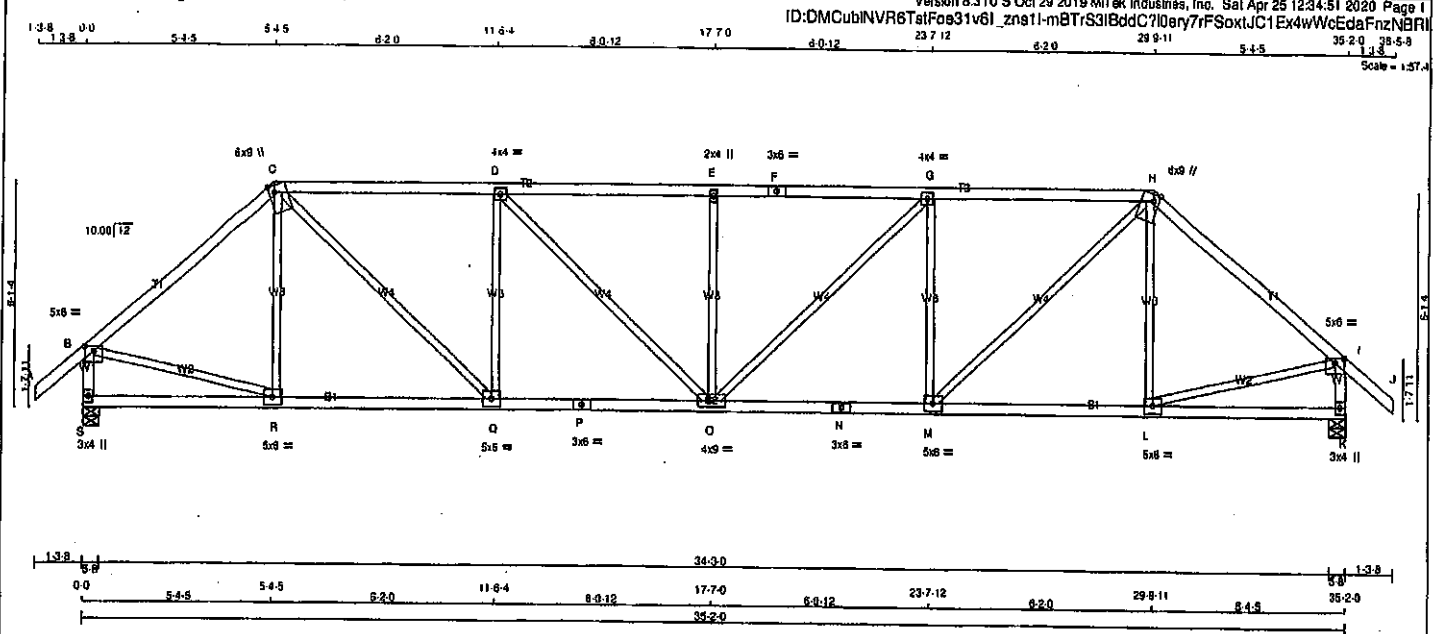

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
S - P	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN Y	X
B TMW-p	MT20	5.0	8.0	1.50 3.00
C ITWW+m	MT20	8.0	9.0	Edge 1.75
D TMW-t	MT20	4.0	4.0	
E TMW-w	MT20	2.0	4.0	
F TS-l	MT20	3.0	6.0	
G TMW-t	MT20	4.0	4.0	
H ITWW+m	MT20	8.0	9.0	Edge 1.75
I TMW-p	MT20	5.0	8.0	1.50 3.00
K BMW-t+p	MT20	3.0	4.0	
L, M, Q, R				
L BMW-t	MT20	5.0	8.0	
N BS-l	MT20	3.0	8.0	
O BMW-w	MT20	4.0	9.0	
P BS-l	MT20	3.0	8.0	
S BMW-t+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
S	2088	0	2088	0	5-8
K	2088	0	2088	0	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
K	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.28 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)
FR-TO			
A-B	0 / 41	-91.8 -91.8 0.13 (1)	10.00
B-C	-2004 / 0	-91.8 -91.8 0.84 (1)	4.11
C-D	-2853 / 0	-91.8 -91.8 0.74 (1)	3.50
D-E	-2978 / 0	-91.8 -91.8 0.78 (1)	3.28
E-F	-2978 / 0	-91.8 -91.8 0.78 (1)	3.28
F-G	-2978 / 0	-91.8 -91.8 0.78 (1)	3.28
G-H	-2853 / 0	-91.8 -91.8 0.74 (1)	3.50
H-I	-2004 / 0	-91.8 -91.8 0.84 (1)	4.11
I-J	0 / 41	-91.8 -91.8 0.13 (1)	10.00
S-B	-2028 / 0	0.0 0.0 0.22 (1)	5.94
K-I	-2028 / 0	0.0 0.0 0.22 (1)	5.94
S-R	0 / 0	-18.5 -18.5 0.14 (4)	10.00
R-Q	0 / 1532	-18.5 -18.5 0.83 (1)	10.00
Q-P	0 / 2853	-18.5 -18.5 0.49 (1)	10.00
P-O	0 / 2853	-18.5 -18.5 0.49 (1)	10.00
O-N	0 / 2853	-18.5 -18.5 0.49 (1)	10.00
N-M	0 / 2853	-18.5 -18.5 0.49 (1)	10.00
M-L	0 / 1532	-18.5 -18.5 0.33 (1)	10.00
L-K	0 / 0	-18.5 -18.5 0.14 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2018
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.18")
ALLOWABLE DEFL.(TL) = L/380 (1.17")
CALCULATED VERT. DEFL.(TL) = L/899 (0.29")

CSI: TC=0.78/1.00 (E-G:1), BC=0.49/1.00 (M-O:1), WB=0.55/1.00 (G-M:1), SS=0.27/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

MAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (R) (INPUT = 0.90)
JSI METAL = 0.85 (N) (INPUT = 1.00)

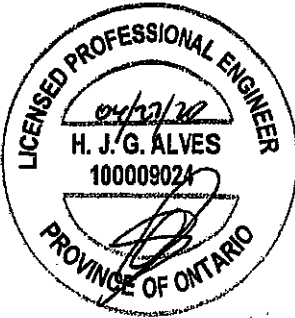

Structural component only
DWG# T-2007132

Version 8.310.8 Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:34:52 2020 Page 1
ID:DMCubiNVR6TstFoe31v8l zns1l-EN1DIPipOxKsNAD1WqNu_?T6RbNZqQVfrumBoDzNBRAH

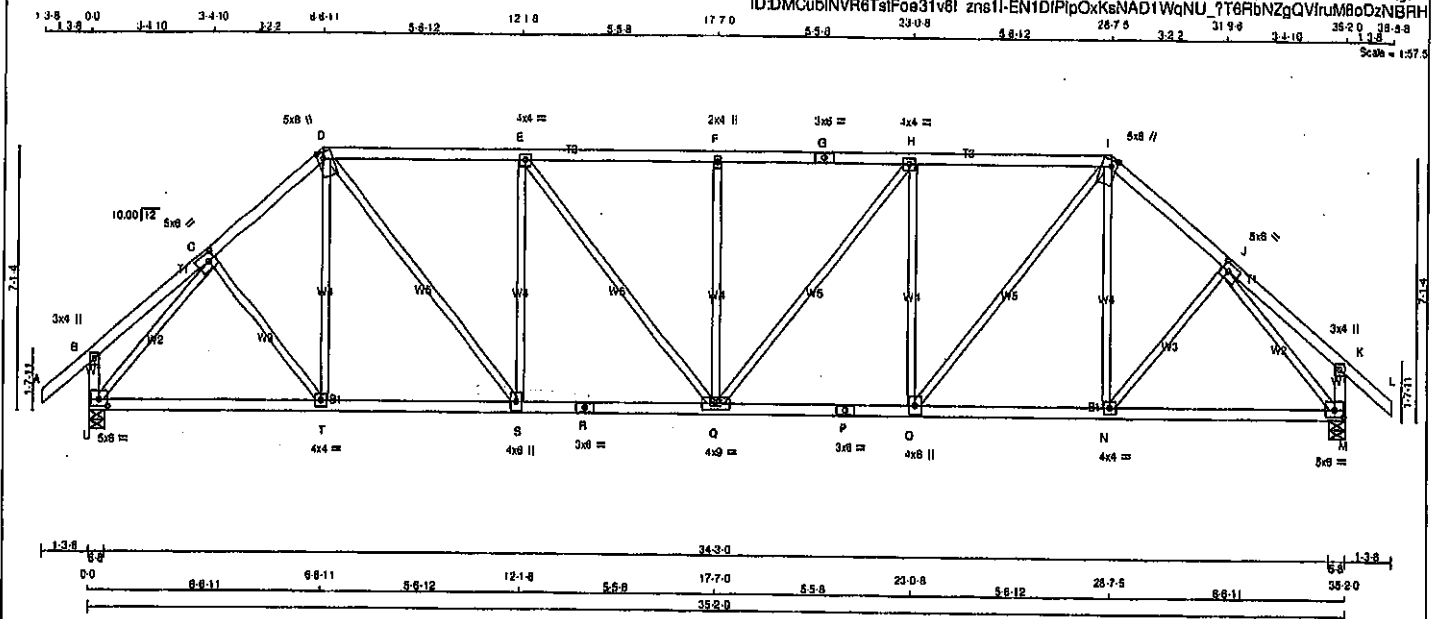

LUMBER				
M. L. S. A. RULES				
CHORDS	SIZE	LUMBER	DESCR	
A - D	2x4	DRY	No.2	SFF
D - G	2x4	DRY	No.2	SFF
G - I	2x4	DRY	No.2	SFF
I - L	2x4	DRY	No.2	SFF
U - B	2x4	DRY	No.2	SFF
M - K	2x4	DRY	No.2	SFF
U - F	2x4	DRY	No.2	SFF
R - P	2x4	DRY	No.2	SFF
P - M	2x4	DRY	No.2	SFF

ALL WEBS 2x3 DRY
EXCEPT
DRY: SEASONED LUMBER.

JT	TYPE	PLATES	W	LEN	Y	X
B	TMOV-4	MT20	3.0	4.0		
C	TMOVW-1	MT20	5.0	6.0	2.50	2.25
D	TTWW-4m	MT20	5.0	8.0	2.00	1.75
E	TMOVW-1	MT20	4.0	4.0		
F	TMOV-4w	MT20	2.0	4.0		
G	TS-1	MT20	3.0	6.0		
H	TMOVW-1	MT20	4.0	4.0		
I	TTWW-4m	MT20	5.0	8.0	2.00	1.75
J	TMOVW-1	MT20	5.0	6.0	2.50	2.25
K	TMOV-4p	MT20	3.0	4.0		
M	BMOVW-1	MT20	5.0	6.0	2.25	3.00
N	BMOVW-1	MT20	4.0	4.0		
O	BMOVW-1	MT20	4.0	8.0		
P	SS-1	MT20	3.0	6.0		
Q	BMOVW-1	MT20	4.0	6.0		
R	BS-1	MT20	3.0	6.0		
S	BMOVW-1	MT20	4.0	6.0		
T	BMOVW-1	MT20	4.0	4.0		
U	BMOVW-1	MT20	5.0	6.0	2.25	3.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRQ	REQD BRQ
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
U	2088	0	2088	0	0	6-8	6-8
M	2088	0	2088	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
U	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
M	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBB			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LCI (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	C-T	0 / 156
B-C	0 / 19	-91.8	-91.8	0.14 (1)	10.00	T-D	0 / 78
C-D	-2023 / 0	-91.8	-91.8	0.20 (1)	4.59	D-S	0 / 1220
D-E	-2308 / 0	-91.8	-91.8	0.55 (1)	3.94	S-E	-850 / 0
E-F	-2534 / 0	-91.8	-91.8	0.67 (1)	3.77	Q-Q	0 / 361
F-G	-2534 / 0	-91.8	-91.8	0.57 (1)	3.77	Q-F	-461 / 0
G-H	-2534 / 0	-91.8	-91.8	0.57 (1)	3.77	H-H	0 / 361
H-I	-2308 / 0	-91.8	-91.8	0.55 (1)	3.94	O-H	-850 / 0
I-J	-2023 / 0	-91.8	-91.8	0.20 (1)	4.59	C-I	0 / 1220
J-K	0 / 19	-91.8	-91.8	0.14 (1)	10.00	N-I	0 / 78
K-L	0 / 41	-91.8	-91.8	0.13 (1)	10.00	N-J	0 / 156
U-B	-248 / 0	0.0	0.0	0.03 (1)	7.81	U-C	-2277 / 0
M-K	-248 / 0	0.0	0.0	0.03 (1)	7.81	J-M	-2277 / 0
U-T	0 / 1433	-18.5	-18.5	0.33 (1)	10.00		
T-S	0 / 1535	-18.5	-18.5	0.35 (1)	10.00		
S-R	0 / 2308	-18.5	-18.5	0.42 (1)	10.00		
R-Q	0 / 2308	-18.5	-18.5	0.42 (1)	10.00		
Q-P	0 / 2308	-18.5	-18.5	0.42 (1)	10.00		
P-O	0 / 2308	-18.5	-18.5	0.42 (1)	10.00		
O-N	0 / 1535	-18.5	-18.5	0.35 (1)	10.00		
N-M	0 / 1433	-18.5	-18.5	0.33 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCO 2010, NBCO 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF EBCO 2018, OBC 2012, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.17")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.13")
ALLOWABLE DEFL.(TL) = $L/360$ (1.17")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.23")

CSI: TC=0.57/1.00 (E-F:1), BC=0.42/1.00 (O-Q:1),
WB=0.98/1.00 (J-M:1), SS=0.24/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1856

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.89 (I) (INPUT = 0.90)
JSI METAL= 0.72 (P) (INPUT = 1.00)

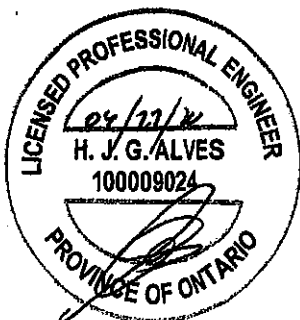

Structural component only
DWG# T-2007133

JOB NAME 408168	TRUSS NAME T5	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 26 12:34:53 2020 Page 1
 ID:DMCubINVR6TsFoe31v6I_zns1I-habbtJR9ESJ_KoE4YUjXDOEb7ipPtp4Y6hKizNBRG
 1-3.8 0.0 3-11.13 3-11.13 7-9.2 7-9.2 14-4-2 14-4-2 20-9-14 20-9-14 27-4-14 27-4-14 31-2-3 31-2-3 35-2-0 35-2-0
 Scale = 1:37.5

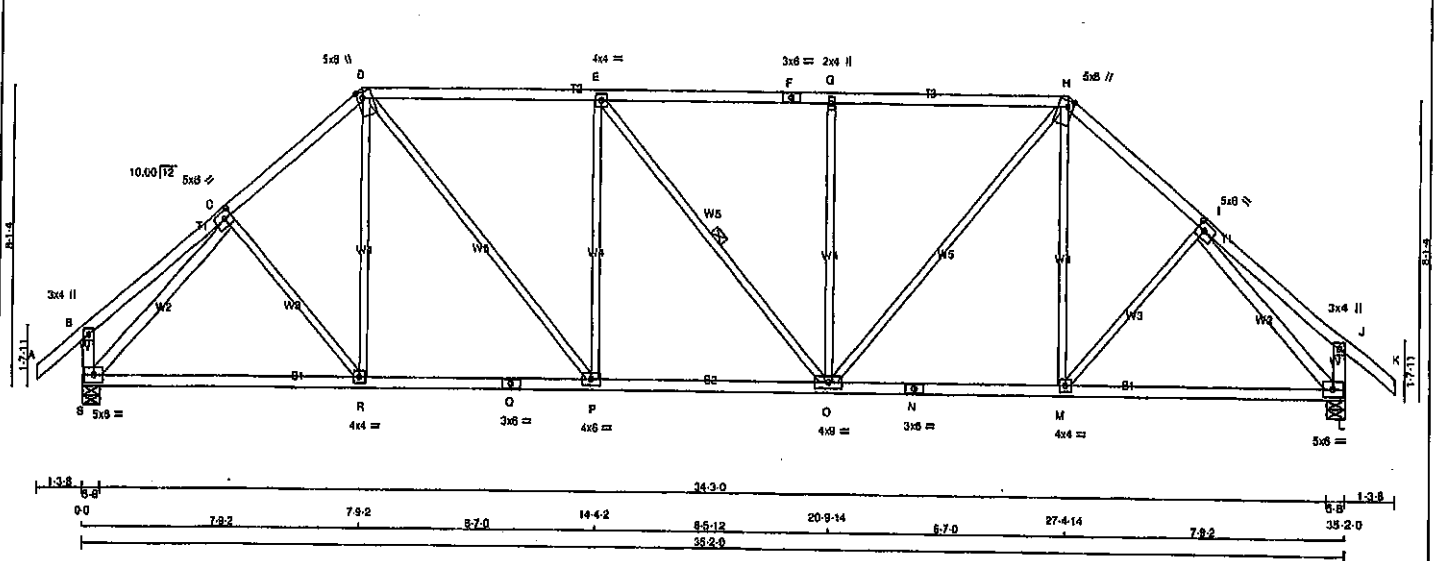

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMWV+m	MT20	5.0	8.0	2.50 2.50
D	TTWV+m	MT20	5.0	8.0	2.00 1.75
E	TMWV+m	MT20	4.0	4.0	
F	TS-i	MT20	3.0	8.0	
G	TMWV+m	MT20	2.0	4.0	
H	TTWV+m	MT20	5.0	8.0	2.00 1.75
I	TMWV+m	MT20	5.0	8.0	2.50 2.50
J	TMV+p	MT20	3.0	4.0	
L	BMWV-i	MT20	5.0	8.0	
M	BMWV-i	MT20	4.0	4.0	
N	BS-i	MT20	3.0	8.0	
O	BMWV-i	MT20	4.0	8.0	
P	BMWV-i	MT20	4.0	8.0	
Q	BS-i	MT20	3.0	8.0	
R	BMWV-i	MT20	4.0	4.0	
S	BMWV-i	MT20	5.0	8.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
S	2088	0	2088	0	5-8	5-8	5-8
L	2088	0	2088	0	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS				
S	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.81 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8 -91.8	0.13 (1)	C-R	0 / 64	0.02 (4)	
B-C	0 / 26	-91.8 -91.8	0.21 (1)	D-P	0 / 128	0.04 (4)	
C-D	-2008 / 0	-91.8 -91.8	0.29 (1)	E-O	0 / 998	0.22 (1)	
D-E	-2163 / 0	-91.8 -91.8	0.73 (1)	F-P	-650 / 0	0.82 (1)	
E-F	-2162 / 0	-91.8 -91.8	0.73 (1)	G-O	-2 / 0	0.00 (1)	
F-G	-2162 / 0	-91.8 -91.8	0.73 (1)	H-O	-649 / 0	0.82 (1)	
G-H	-2162 / 0	-91.8 -91.8	0.73 (1)	I-O	0 / 998	0.22 (1)	
H-I	-2008 / 0	-91.8 -91.8	0.29 (1)	M-I	0 / 128	0.04 (4)	
I-J	0 / 26	-91.8 -91.8	0.21 (1)	N-I	0 / 64	0.02 (4)	
J-K	0 / 41	-91.8 -91.8	0.13 (1)	S-C	-2291 / 0	0.87 (1)	
S-B	-284 / 0	0.0 0.0	0.03 (1)	T-L	-2291 / 0	0.87 (1)	
L-J	-284 / 0	0.0 0.0	0.03 (1)				
S-R	0 / 1487	-18.5 -18.5	0.38 (1)				
R-Q	0 / 1519	-18.5 -18.5	0.39 (1)				
Q-P	0 / 1519	-18.5 -18.5	0.39 (1)				
P-O	0 / 2183	-18.5 -18.5	0.42 (1)				
O-N	0 / 1519	-18.5 -18.5	0.39 (1)				
N-M	0 / 1519	-18.5 -18.5	0.39 (1)				
M-L	0 / 1487	-18.5 -18.5	0.38 (1)				

TOTAL WEIGHT = 2 X 163 = 326 b

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/899 (0.10")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.21")

CSI: TC=0.73/1.00 (D-E-1), SC=0.42/1.00 (O-P-1), WB=0.97/1.00 (H-L-1), SS=0.28/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PS) (PL) (PL)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.87 (1) (INPUT = 0.90)
 JSI METAL= 0.56 (1) (INPUT = 1.00)



Structural component only
 DWG# T-2007134

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T6	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 9 Oct 20 2019 Mitok Industries, Inc. Sat Apr 25 12:34:55 2020 Page 1
ID:DMCubINVR6TsF0e31v8l_zns1l-eylLRLhhsIQEaycBzwBce5fFpQxtxr5XsboOYzNBRE

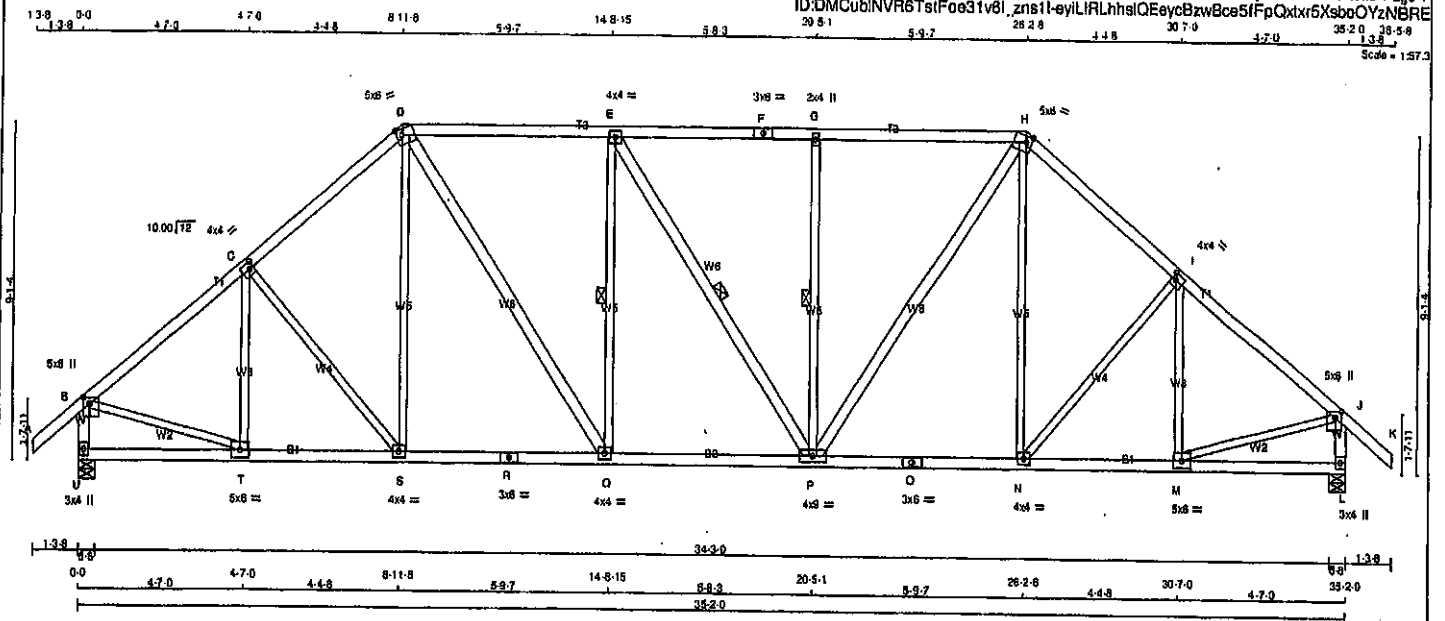

CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
J - L	2x4	DRY	No.2
L - U	2x4	DRY	No.2
U - W	2x4	DRY	No.2
W - X	2x4	DRY	No.2
X - Y	2x4	DRY	No.2
Y - Z	2x4	DRY	No.2

ALL WEBS	SIZE	DRY	LUMBER
EXCEPT	2x4	DRY	No.2
D - Q	2x4	DRY	No.2
E - P	2x4	DRY	No.2
P - H	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATE TYPE	PLATE SIZE	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	2.00	2.00
C TMVW-l	MT20	4.0	4.0	2.00	1.25
D TTWW-m	MT20	5.0	8.0	2.00	1.75
E TMVW-l	MT20	4.0	4.0		
F TS-l	MT20	3.0	8.0		
G TMVW-w	MT20	2.0	4.0		
H TTWW-m	MT20	5.0	8.0	2.00	1.75
I TMVW-l	MT20	4.0	4.0	2.00	1.25
J TMVW-p	MT20	5.0	8.0	2.00	2.00
L BMV1-p	MT20	3.0	4.0		
M BMVW-l	MT20	5.0	8.0		
N Q.S					
N BMVW-l	MT20	4.0	4.0		
O BS-l	MT20	3.0	8.0		
P BMVW-l	MT20	4.0	8.0		
R BS-l	MT20	3.0	8.0		
T BMVW-l	MT20	5.0	8.0		
U BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UPLIFT	IN-SX
U	2068	0	5-8	5-8
L	2068	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN	COMPONENT REACTIONS
	COMBINED	LIVE	PERM.LIVE
U	1458	971/0	0/0
L	1458	971/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.44 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, E-P, G-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS

MEMB. MAX. FACTORED FORCE (LBS)

FACTORED VERT. LOAD (PL)

MAX. FACTORED CS (LC)

MAX. FACTORED UNBRACED LENGTH (FT)

MEMB. MAX. FACTORED FORCE (LBS)

MAX. FACTORED CS (LC)

FR-TO. FROM TO

A-B -1994/0

B-C -1957/0

C-D -1923/0

D-E -1921/0

E-F -1921/0

F-G -1921/0

G-H -1921/0

H-I -1957/0

I-J -1994/0

J-K -1957/0

K-L -1957/0

L-M -1957/0

M-N -1957/0

N-O -1957/0

O-P -1957/0

P-Q -1957/0

Q-R -1957/0

R-S -1957/0

S-T -1957/0

T-U -1957/0

U-V -1957/0

V-W -1957/0

W-X -1957/0

X-Y -1957/0

Y-Z -1957/0

Z-A -1957/0

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019

- PART 9 OF CBC 2012 (2019 AMENDMENT)

- CSA 086-09, CSA 086-14

- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")

CALCULATED VERT. DEFL.(LL) = L/999 (0.08")

ALLOWABLE DEFL.(TL) = L/360 (1.17")

CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CSI: TC=0.40/1.00 (D-E:1), BC=0.38/1.00 (P-Q:1),

WB=0.38/1.00 (B-T:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PS) (PL) (PL)

MAX MIN MAX MIN MAX MIN

MT20 616 354 1697 788 1987 1688

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (B) (INPUT = 0.80)

JSI METAL = 0.60 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007135

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T7	5	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 12:34:56 2020 Page 1

ID:DMCubINVR6TatFoe31v8l_zns1f-79GkVnMJS9qHmXpQ9RakDmacKeFmWKLx_zNBRD

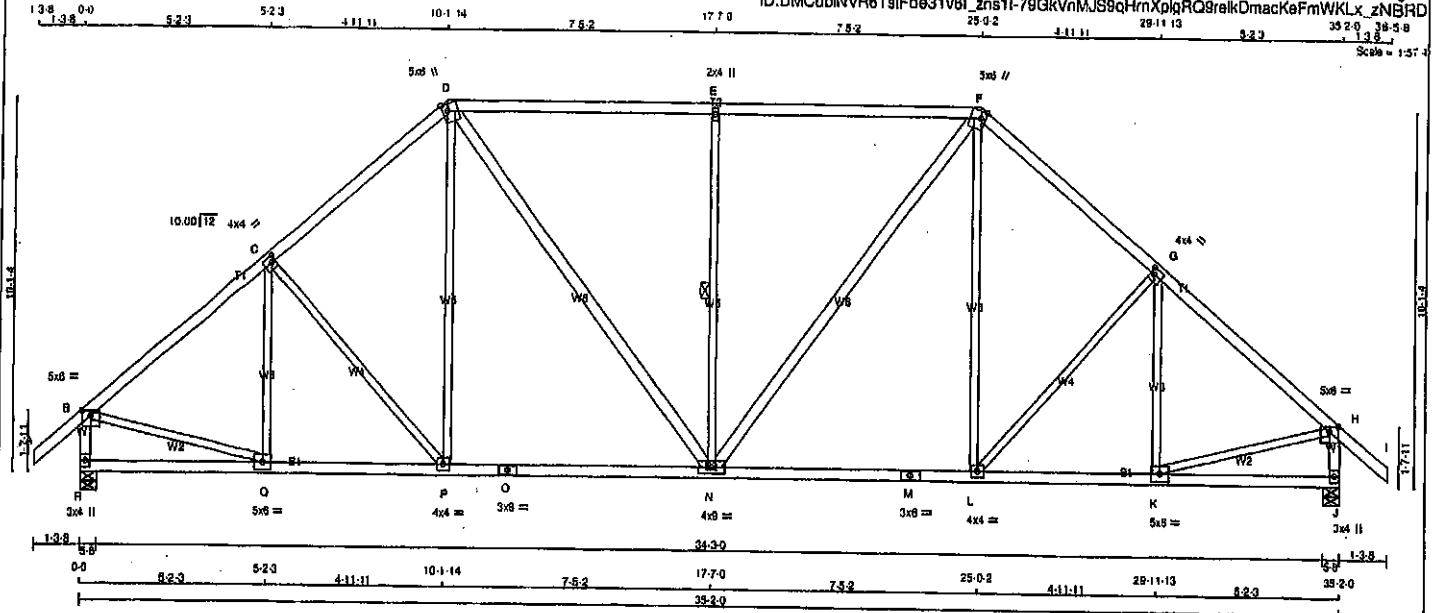

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
R - B	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
R - O	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
D - N	2x4	DRY	No.2	SPF	
N - F	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)	W	LEN	Y	X
JT TYPE				
B TMVW-p	MT20	5.0	6.0	1.50 3.00
C TMVW-l	MT20	4.0	4.0	2.00 1.25
D TTWW+m	MT20	5.0	6.0	2.25 1.50
E TMVW-w	MT20	2.0	4.0	
F TTWW+m	MT20	5.0	6.0	2.25 1.50
G TMVW-l	MT20	4.0	4.0	2.00 1.25
H TMVW-p	MT20	5.0	6.0	1.50 3.00
J BMV1-p	MT20	3.0	4.0	
K BMVW-l	MT20	5.0	6.0	
L BMVW-l	MT20	4.0	4.0	
M BS-l	MT20	3.0	6.0	
N BMVW-l	MT20	4.0	6.0	
O BS-l	MT20	3.0	6.0	
P BMVW-l	MT20	4.0	4.0	
Q BMVW-l	MT20	5.0	6.0	
R BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORIZ	UPLIFT
R	2068	0	2068	0
J	2068	0	2068	0

UNFACTORED REACTIONS	1ST LOASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM LIVE WIND DEAD SOIL
R	1458	971 / 0 0 / 0 0 / 0 488 / 0 0 / 0
J	1458	971 / 0 0 / 0 0 / 0 488 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.98 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	W E B S	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 (PLF) CSI (LC)	MEMB.	FORCE (LBS) MAX. FACTORED CSI (LC)
FR-TO			FR-TO	
A-B	0 / 41	-91.8 -91.8 0.13 (1)	Q-C	-302 / 0 0.17 (1)
B-C	-2021 / 0	-91.8 -91.8 0.39 (1)	C-P	-217 / 0 0.25 (1)
C-D	-1908 / 0	-91.8 -91.8 0.37 (1)	P-D	0 / 278 0.08 (1)
D-E	-1809 / 0	-91.8 -91.8 0.74 (1)	D-N	0 / 615 0.10 (1)
E-F	-1809 / 0	-91.8 -91.8 0.74 (1)	N-E	-838 / 0 0.58 (1)
F-G	-1908 / 0	-91.8 -91.8 0.37 (1)	N-F	0 / 615 0.10 (1)
G-H	-2021 / 0	-91.8 -91.8 0.39 (1)	L-F	-0 / 278 0.08 (1)
H-I	0 / 41	-91.8 -91.8 0.13 (1)	L-G	-217 / 0 0.25 (1)
R-B	-2024 / 0	0.0 0.0 0.22 (1)	K-G	-302 / 0 0.17 (1)
J-H	-2024 / 0	0.0 0.0 0.22 (1)	B-Q	0 / 1629 0.37 (1)
			K-H	0 / 1629 0.37 (1)
R-Q	0 / 0	-18.5 -18.5 0.10 (4)		
Q-P	0 / 1580	-18.5 -18.5 0.34 (1)		
P-O	0 / 1437	-18.5 -18.5 0.35 (1)		
O-N	0 / 1437	-18.5 -18.5 0.35 (1)		
N-M	0 / 1437	-18.5 -18.5 0.35 (1)		
M-L	0 / 1437	-18.5 -18.5 0.35 (1)		
L-K	0 / 1590	-18.5 -18.5 0.34 (1)		
K-J	0 / 0	-18.5 -18.5 0.10 (4)		

TOTAL WEIGHT = 5 X 173 = 867 lb (M/P)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C/C

LOADING IN PLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/880 (1.17")
CALCULATED VERT. DEFL.(LL) = 1/989 (0.08")
ALLOWABLE DEFL.(TL) = L/880 (1.17")
CALCULATED VERT. DEFL.(TL) = 1/989 (0.17")

CSI: TC=0.74/1.00 (D-E:1), BC=0.35/1.00 (L-N:1), WB=0.58/1.00 (E-N:1), SSI=0.33/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1887 1888

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.69 (H) (INPUT = 0.90)
JSI METAL = 0.46 (O) (INPUT = 1.00)



Structural component only
DWG# T-2007136

JOB NAME 408168	TRUSS NAME T9	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:58 2020 Page 1
ID:DMCubINVR6TelFoe31v6I_zns11-3XOUwSNa_n6785hBisUueGID_0Uq4EhYDqpS7tzNBRB

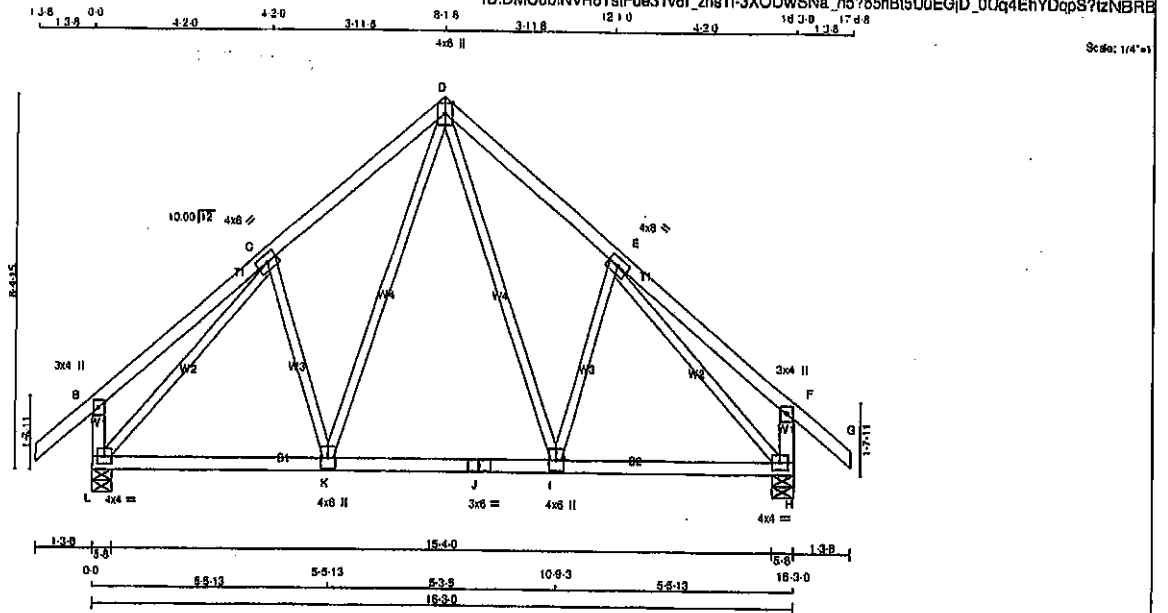

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4 DRY	No.2		
D - G	2x4 DRY	No.2		
L - B	2x4 DRY	No.2		
H - F	2x4 DRY	No.2		
L - J	2x4 DRY	No.2		
J - H	2x4 DRY	No.2		

ALL WEBS 2x3 DRY No.2
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
B TMV+p MT20	3.0	4.0		
C TMVW+ MT20	4.0	6.0		
D TTWW+p MT20	4.0	6.0		
E TMVW+ MT20	4.0	6.0		
F TMV+p MT20	3.0	4.0		
H BMVW+ MT20	4.0	4.0		
I BMVW+ MT20	4.0	6.0		
J BS+ MT20	3.0	6.0		
K BMVW+ MT20	4.0	6.0		
L BMVW+ MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
		GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
L	1023	0	1023	0	0	5-8	5-8		
H	1023	0	1023	0	0	5-8	5-8		

UNFACTORED REACTIONS		1ST LOASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
L	721	487 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0		
H	721	487 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)							
CHORDS		MAX. FACTORED		FACTORED		MAX. FACTORED		WEBS	
MEMB.	FORCE	VERT.	LOAD	LC1	MAX	MEMB.	FORCE	MAX	MAX
FR-TO	(LBS)	FROM	TO	CSI (LC)	LENGTH	FR-TO	(LBS)	CSI (LC)	
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	D-I	0 / 330	0.07 (1)	
B-C	0 / 28	-91.8	-91.8	0.24 (1)	10.00	I-E	-216 / 0	0.09 (1)	
C-D	-745 / 0	-91.8	-91.8	0.19 (1)	8.25	K-D	0 / 330	0.07 (1)	
D-E	-745 / 0	-91.8	-91.8	0.19 (1)	8.25	C-K	-216 / 0	0.09 (1)	
E-F	0 / 28	-91.8	-91.8	0.24 (1)	10.00	L-C	-943 / 0	0.81 (1)	
F-G	0 / 41	-91.8	-91.8	0.13 (1)	10.00	E-H	-943 / 0	0.81 (1)	
L-B	-287 / 0	0.0	0.0	0.03 (1)	7.81				
H-F	-287 / 0	0.0	0.0	0.03 (1)	7.81				
L-K	0 / 616	-18.5	-18.5	0.17 (4)	10.00				
K-J	0 / 449	-18.5	-18.5	0.16 (4)	10.00				
J-I	0 / 449	-18.5	-18.5	0.16 (4)	10.00				
I-H	0 / 616	-18.5	-18.5	0.17 (4)	10.00				

TOTAL WEIGHT = 8 X 80 = 481 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2010, NBCO 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.64")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/380 (0.64")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.24/1.00 (B-C:1), BC=0.17/1.00 (H-I:4), WB=0.61/1.00 (C-L:1), SS=0.14/1.00 (G-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1697 788 1997 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.76 (C) (INPUT = 0.90)
JSI METAL = 0.25 (C) (INPUT = 1.00)

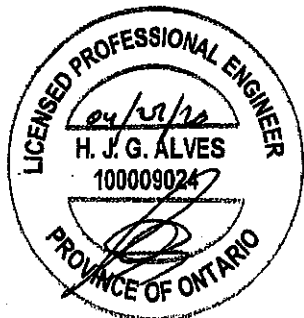


Structural component only
DWG# T-2007138

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	G9	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 8 Oct 2019 MTek Industries, Inc. Sat Apr 25 12:34:40 2020 Page 1

ID:DMCubINVR6TstFos31v6l_znsf1-b4lh8J9HDFpZxKJkpJ9gVTzANmNyICAu40SVMwzNBRT



Scale: 1/4\"/>

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - F	2x4	DRY	No.2
F - K	2x4	DRY	No.2
U - 8	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			
GABLE STUDS SPACED AT 2-0-0 OC.			

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMW+p	MT20	4.0	4.0	1.00 2.00
C, D, E, G, H, I				
C TMW+w	MT20	2.0	4.0	
F TMW+p	MT20	4.0	8.0	Edge
J TMW+p	MT20	4.0	4.0	1.00 2.00
L BMW1+p	MT20	3.0	4.0	
M BMW1+1	MT20	4.0	4.0	
N, P, Q, R, S				
N BMW1+w	MT20	2.0	4.0	
O BS1	MT20	3.0	6.0	
T BMW1+1	MT20	4.0	4.0	
U BMW1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
A-B	0/41	-91.8 -91.8	0.13 (1)	Q-F	-124/0	0.17 (1)	
B-C	-28/0	-91.8 -91.8	0.05 (1)	R-E	-210/0	0.18 (1)	
C-D	-36/0	-91.8 -91.8	0.05 (1)	S-D	-189/0	0.08 (1)	
D-E	-24/0	-91.8 -91.8	0.05 (1)	T-C	-205/0	0.04 (1)	
E-F	-36/0	-91.8 -91.8	0.05 (1)	P-G	-210/0	0.16 (1)	
F-G	-36/0	-91.8 -91.8	0.05 (1)	N-H	-169/0	0.08 (1)	
G-H	-24/0	-91.8 -91.8	0.05 (1)	M-I	-205/0	0.04 (1)	
H-I	-36/0	-91.8 -91.8	0.05 (1)	B-T	0/37	0.01 (1)	
I-J	-28/0	-91.8 -91.8	0.05 (1)	M-J	0/37	0.01 (1)	
J-K	0/41	-91.8 -91.8	0.13 (1)				
U-B	-248/0	0.0 0.0	0.03 (1)				
L-J	-246/0	0.0 0.0	0.03 (1)				
U-T	0/0	-18.5 -18.5	0.02 (4)				
T-S	0/25	-18.5 -18.5	0.02 (4)				
S-R	0/21	-18.5 -18.5	0.02 (4)				
R-Q	0/18	-18.5 -18.5	0.02 (4)				
Q-P	0/18	-18.5 -18.5	0.02 (4)				
P-O	0/21	-18.5 -18.5	0.02 (4)				
O-N	0/21	-18.5 -18.5	0.02 (4)				
N-M	0/25	-18.5 -18.5	0.02 (4)				
M-L	0/0	-18.5 -18.5	0.02 (4)				

TOTAL WEIGHT = 81 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CS: TO=0.13/1.00 (A-B:1), BC=0.02/1.00 (M-N:4), WB=0.17/1.00 (F-Q:1), SG=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRV)	SHEAR	SECTION
(PS)	(PL)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1887 798	1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.52 (T) (INPUT = 0.90)

JSI METAL=0.11 (G) (INPUT = 1.00)




Structural component only
DWG# T-2007123

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408168	G10	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 20 2019 Mitek Industries, Inc. Sat Apr 25 12:34:41 2020 Page 1
ID:DMCubINVR6TstFos31v6I_zns11-3Gs3MeAv_YyQYUwN0gv2hWL7AJCchL2JgC3vMzNBRS

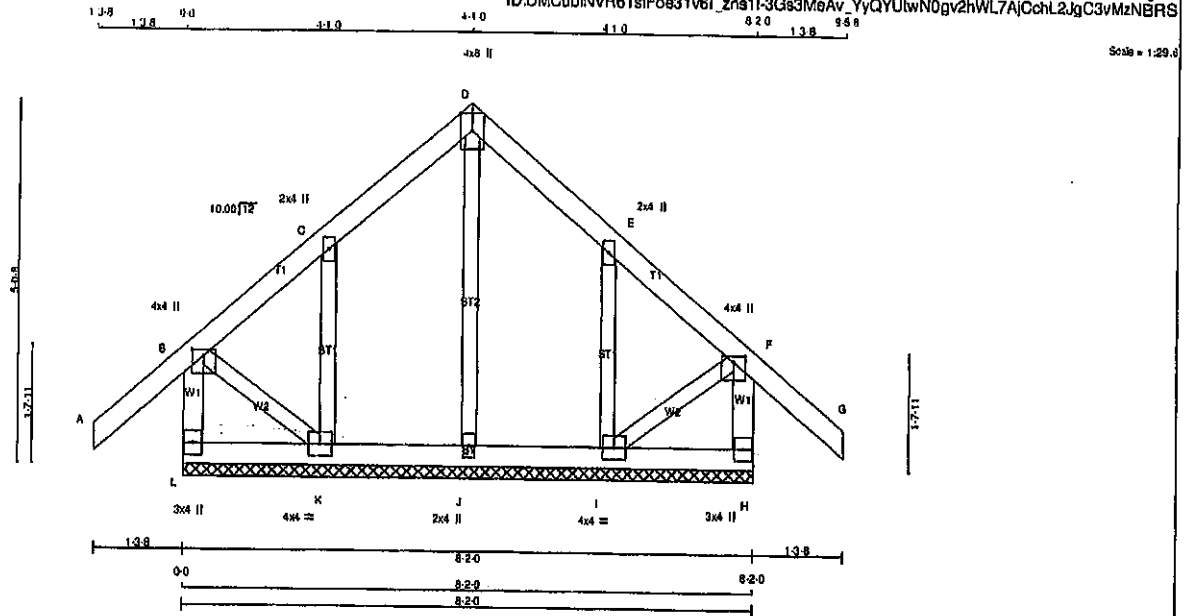

LUMBER				
N. L. G. A. RULES	SIZE	LUMBER	DESCR.	
CHORDS				
L - B	2x4 DRY	No.2	SPF	
A - D	2x4 DRY	No.2	SPF	
D - G	2x4 DRY	No.2	SPF	
H - F	2x4 DRY	No.2	SPF	
L - H	2x4 DRY	No.2	SPF	
ALL WEBS	2x3 DRY	No.2	SPF	
ALL GABLE WEBS	2x3 DRY	No.2	SPF	
DRY: SEASONED LUMBER.				
GABLE STUDS SPACED AT 2'-0" O.C.				

PLATES (tablets in inches)				
JT TYPE	PLATES	W	LEN	X
B TMVW+p	MT20	4.0	4.0	1.00 2.00
C TMVW+w	MT20	2.0	4.0	
D TTW+p	MT20	4.0	8.0	Edge
E TMVW+w	MT20	2.0	4.0	
F TMVW+p	MT20	4.0	4.0	1.00 2.00
H BMV1+p	MT20	3.0	4.0	
I BMW1-i	MT20	4.0	4.0	
J BMW1+w	MT20	2.0	4.0	
K BMW1-i	MT20	4.0	4.0	
L BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.									
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.									
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)									
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.									
LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LCI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LCI (LC)	MAX. UNBRACED LENGTH	MEMB.
FR-TO					FR-TO				
L-B	-224 / 0	0.0	0.0	0.02 (1)	J-D	-126 / 0	0.05 (1)		
A-B	0 / 41	-91.8	-91.8	0.13 (1)	K-G	-227 / 0	0.04 (1)		
B-C	-11 / 0	-91.8	-91.8	0.06 (1)	I-E	-227 / 0	0.04 (1)		
C-D	-31 / 0	-91.8	-91.8	0.06 (1)	B-K	0 / 24	0.01 (1)		
D-E	-31 / 0	-91.8	-91.8	0.06 (1)	I-F	0 / 24	0.01 (1)		
E-F	-11 / 0	-91.8	-91.8	0.06 (1)					
F-G	0 / 41	-91.8	-91.8	0.13 (1)					
H-F	-224 / 0	0.0	0.0	0.02 (1)					
L-K	0 / 0	-18.5	-18.5	0.02 (4)					
K-J	0 / 13	-18.5	-18.5	0.02 (4)					
J-I	0 / 13	-18.5	-18.5	0.02 (4)					
I-H	0 / 0	-18.5	-18.5	0.02 (4)					

TOTAL WEIGHT = 40 lb (lb)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2015, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(85% OF 31.3 P.S.F. G.S.L. PLUS 9.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TO=0.13/1.00 (A-B:1), BC=0.02/1.00 (J-K:4), WB=0.05/1.00 (D-J:1), SG=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1687 1686

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.17 (C) (INPUT = 0.80)
JSI METAL= 0.12 (C) (INPUT = 1.00)

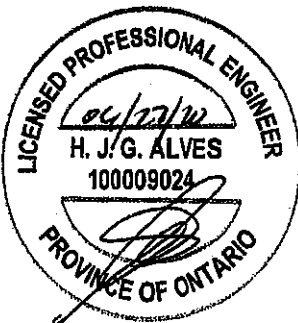

Structural component only
DWG# T-2007124

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T11	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 5 Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:35:00 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-7wWEL8PqVOLJKPqa_WWWJhoZlq8hYBarh8lZ4izNBFR9

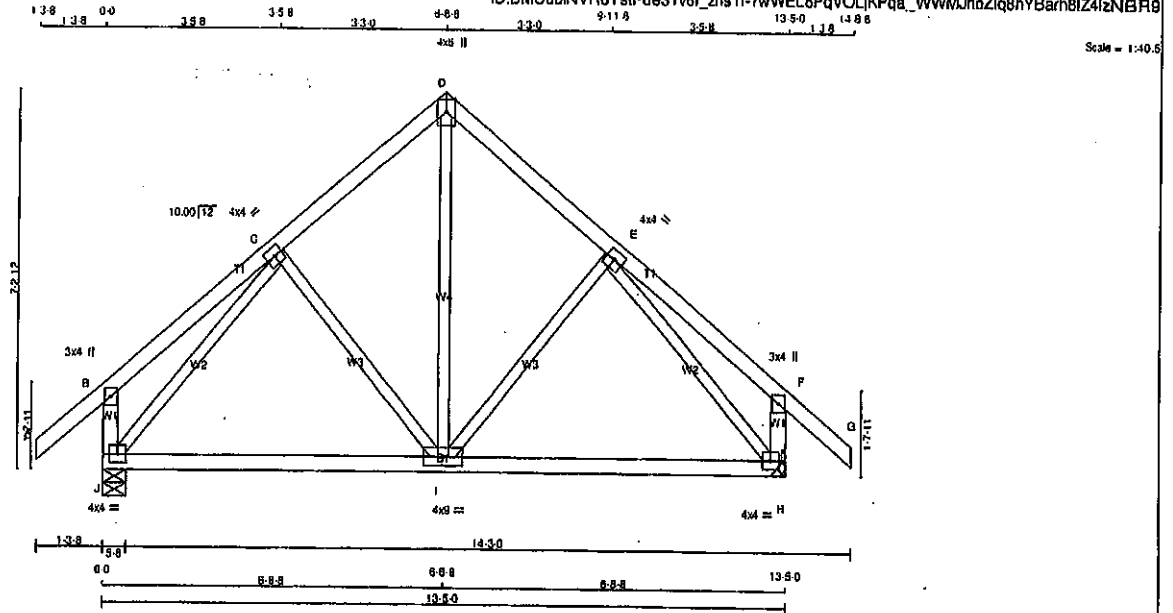

TOTAL WEIGHT = 3 X 64 = 191 lb (M/F)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No. 2	
D - G	2x4	DRY	No. 2	
J - B	2x4	DRY	No. 2	
H - F	2x4	DRY	No. 2	
J - H	2x4	DRY	No. 2	

ALL WEBS 2x3 DRY No. 2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
JT	TMV+p	MT20	3.0	4.0		
B	TMV+p	MT20	3.0	4.0		
C	TMV+p	MT20	4.0	4.0		
D	TTW+p	MT20	4.0	6.0		Edge
E	TMV+p	MT20	4.0	4.0		
F	TMV+p	MT20	3.0	4.0		
H	BMVW1-t	MT20	4.0	4.0		
I	BMVW1-t	MT20	4.0	9.0		
J	BMVW1-t	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORIZ	DOWN	UP
J	887	0	887	0
H	887	0	887	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

1ST LOASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	811	414 / 0	0 / 0	0 / 0	0 / 0	198 / 0	0 / 0
H	811	414 / 0	0 / 0	0 / 0	0 / 0	198 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 / 41	-91.8 -91.8 0.13 (1)	I-D	0 / 382
B-C	0 / 23	-91.8 -91.8 0.16 (1)	I-E	-149 / 0
C-D	-509 / 0	-91.8 -91.8 0.13 (1)	C-I	-149 / 0
D-E	-509 / 0	-91.8 -91.8 0.13 (1)	J-C	-742 / 0
E-F	0 / 23	-91.8 -91.8 0.16 (1)	E-H	-742 / 0
F-G	0 / 41	-91.8 -91.8 0.13 (1)		
J-B	-244 / 0	0.0 0.0 0.03 (1)		
H-F	-244 / 0	0.0 0.0 0.03 (1)		
J-I	0 / 469	-18.5 -18.5 0.27 (4)		
I-H	0 / 469	-18.5 -18.5 0.27 (4)		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL	= 6.0 PSF
80T CH.	LL = 0.0 PSF
DL	= 7.4 PSF
TOTAL	LD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.45")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01")
ALLOWABLE DEFL. (TL) = $L/360$ (0.45")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.05")

CSI: TO=0.16/1.00 (E-F:1), BC=0.27/1.00 (I-H:4),
WB=0.33/1.00 (E-H:1), SSI=0.11/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1867 783	1987 1898

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (E) (INPUT = 0.90)
JSI METAL= 0.27 (E) (INPUT = 1.00)

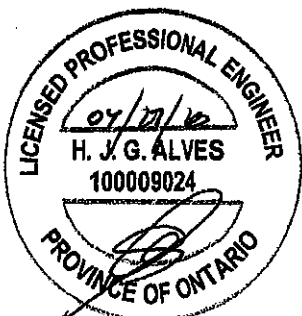

Structural component only
DWG# T-2007140

JOB NAME	TRUSS NAME	QUANTITY	PLV	JOB DESC.	DRWG NO.
408168	G11	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2018 MITek Industries, Inc. Sat Apr 25 12:34:42 2020 Page 1					
ID:DMCubINVR6TstFoe31v8I_zns1I-XSORZ_BXIs4GAeS6xk88au3WtZ3HL6XBYKxcRozNBRR					
Scale = 1/4" = 1'-0"					

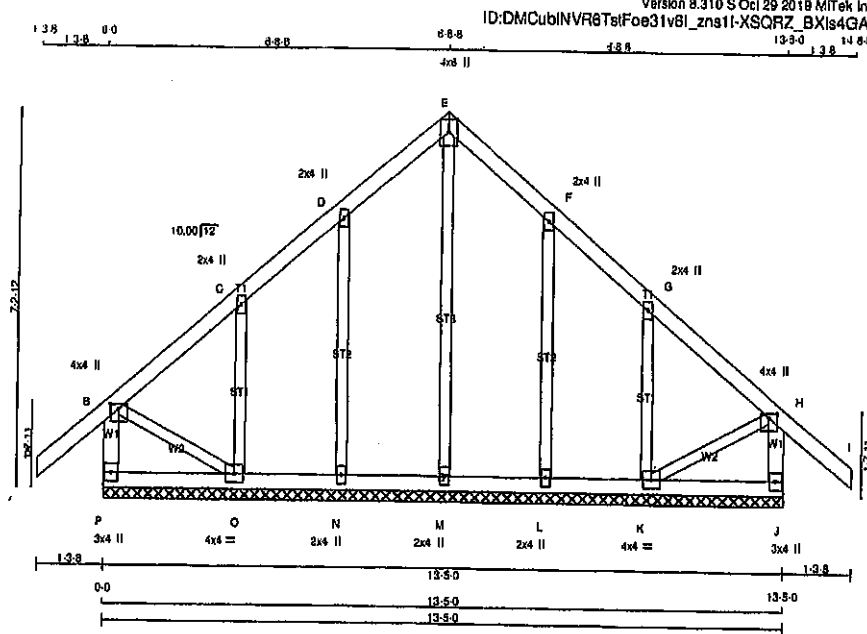

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER
P - B 2x4 DRY No.2
A - E 2x4 DRY No.2
E - I 2x4 DRY No.2
J - H 2x4 DRY No.2
P - J 2x4 DRY No.2
ALL WEBS 2x3 DRY No.2
ALL GABLE WEBS 2x3 DRY No.2
DRY, SEASONED LUMBER.
GABLE STUDS SPACED AT 2'-0" OC.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C, D, F, G					
C TMVW+w	MT20	2.0	4.0		
E TTVW+p	MT20	4.0	6.0	Edge	
H TMVW+p	MT20	4.0	4.0	1.00	2.00
J BMV1+p	MT20	3.0	4.0		
K BMVW1-i	MT20	4.0	4.0		
L, M, N					
L BMV1+w	MT20	2.0	4.0		
O BMVW1-i	MT20	4.0	4.0		
P BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.


DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER
BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)
BRACING
TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	FACTORED LC1 MAX. CSI (LC)
FR-TO		FROM TO		FR-TO			
P-B	-263 / 0	0.0	0.0 0.03 (1)	M-E	-128 / 0	7.61	0.11 (1)
A-B	0 / 41	-91.8	-91.8 0.13 (1)	N-D	-190 / 0	10.00	0.09 (1)
B-C	-24 / 0	-91.8	-91.8 0.08 (1)	O-C	-239 / 0	8.25	0.08 (1)
C-D	-38 / 0	-91.8	-91.8 0.08 (1)	L-F	-190 / 0	8.25	0.09 (1)
D-E	-35 / 0	-91.8	-91.8 0.05 (1)	K-G	-239 / 0	8.25	0.08 (1)
E-F	-35 / 0	-91.8	-91.8 0.05 (1)	B-O	0 / 32	8.25	0.01 (1)
F-G	-38 / 0	-91.8	-91.8 0.08 (1)	K-H	0 / 32	8.25	0.01 (1)
G-H	-24 / 0	-91.8	-91.8 0.08 (1)				
H-I	0 / 41	-91.8	-91.8 0.13 (1)				
J-H	-263 / 0	0.0	0.0 0.03 (1)				
P-O	0 / 0	-18.5	-18.5 0.03 (4)				
O-N	0 / 22	-18.5	-18.5 0.03 (4)				
N-M	0 / 19	-18.5	-18.5 0.02 (4)				
M-L	0 / 19	-18.5	-18.5 0.02 (4)				
L-K	0 / 22	-18.5	-18.5 0.03 (4)				
K-J	0 / 0	-18.5	-18.5 0.03 (4)				


TOTAL WEIGHT = 65 lb

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN. CG
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015
THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014
(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD
CSI: TC=0.13/1.00 (H-I:1), BC=0.03/1.00 (K-L:4), WB=0.11/1.00 (E-M:1), SS=0.08/1.00 (G-H:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10
COMPANION LIVE LOAD FACTOR = 1.00
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1858
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.20 (B) (INPUT = 0.90)
JSI METAL= 0.13 (G) (INPUT = 1.00)

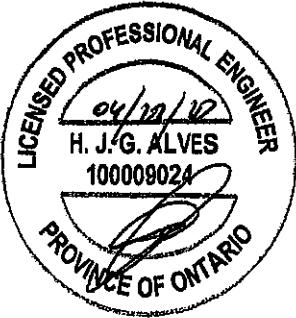

Structural component only
DWG# T-2007125

JOB NAME 408168	TRUSS NAME T12	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:35:01 2020 Page 1	
ID:DMCubINVR6TsFoe31v6I_zms11-T83dYUPSGiAYZPmYD1bsvLXEW1HhI_vn28cCzNBR8				Scale = 1:18.8	

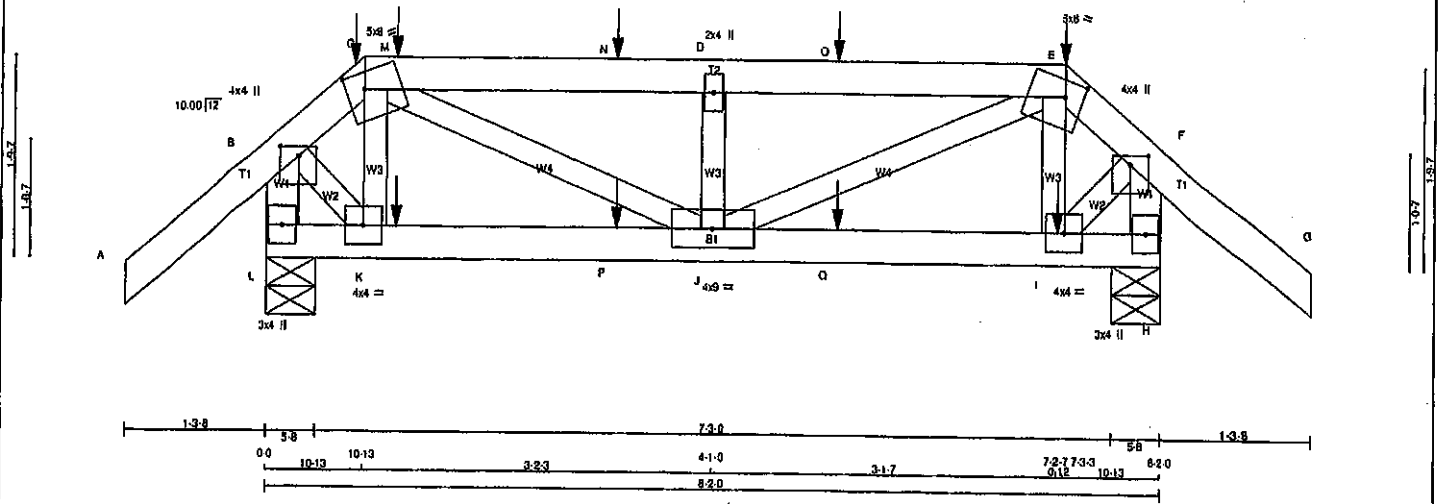

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
L - F	2x4	DRY	No.2
H - H	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
C	TMVW-m	MT20	5.0	8.0	1.75 2.00
D	TMVW-w	MT20	2.0	4.0	
E	TMVW-m	MT20	5.0	8.0	1.75 2.00
F	TMVW+p	MT20	4.0	4.0	1.00 2.00
H	BMV1+p	MT20	3.0	4.0	
I	BMVW-1	MT20	4.0	4.0	
J	BMVW-1	MT20	4.0	9.0	
K	BMVW-1	MT20	4.0	4.0	
L	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	VERT	DOWN	IN-SX	IN-SX
L	913	0	913	0	5-8
H	911	0	911	0	5-8

UNFACTORED REACTIONS		1ST LCASE	MAX/MIN COMPONENT REACTIONS	PERM LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
L	842	442/0	0/0	0/0	0/0	199/0	0/0
H	841	437/0	0/0	0/0	0/0	204/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.82 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	0/41	J-D	-487/0
B-C	-831/0	K-C	-158/0
C-M	-1054/0	C-J	0/700
M-N	-1054/0	B-K	0/525
N-D	-1054/0	I-E	-149/0
D-O	-1054/0	J-E	0/898
O-E	-1054/0	I-F	0/528
E-F	-832/0		
F-G	0/41		
L-B	-938/0		
H-F	-937/0		
L-K	0/0		
K-P	0/420		
P-J	0/420		
J-Q	0/421		
Q-I	0/421		
I-H	0/0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	10-13	-8	-110	---	FRONT	VERT	DEAD	---	C1
C	12-7	-114	-114	---	BACK	VERT	TOTAL	---	C1
C	10-13	-44	-44	---	FRONT	VERT	SNOW	---	C1
E	7-3-3	-9	-10	---	FRONT	VERT	DEAD	---	C1
E	7-3-3	-90	-90	---	BACK	VERT	TOTAL	---	C1
E	7-3-3	-44	-44	---	FRONT	VERT	SNOW	---	C1
I	7-2-7	-49	-49	---	BACK	VERT	TOTAL	---	C1
K	1-2-7	-49	-49	---	BACK	VERT	TOTAL	---	C1
N	3-2-7	-82	-82	---	BACK	VERT	TOTAL	---	C1
O	5-2-7	-82	-82	---	BACK	VERT	TOTAL	---	C1
P	3-2-7	-49	-49	---	BACK	VERT	TOTAL	---	C1
Q	5-2-7	-49	-49	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

I) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 34 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 089-09, CSA 089-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.27")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.27")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CS: TC=0.23/1.00 (C-D:1), BC=0.14/1.00 (H-I:1), WB=0.17/1.00 (C-J:1), SS=0.22/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

CONTINUED ON PAGE 2

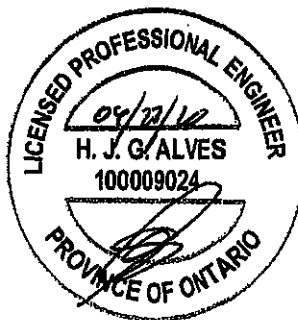


Structural component only
DWG# T-2007141


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408168	T13	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 2019 MITeX Industries, Inc. Sat Apr 25 12:35:03 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_2ns11-PVBZARioJlBz9le33xKQvZ1CWVJHN5XDp4zNBR6



Scale = 1:17.5

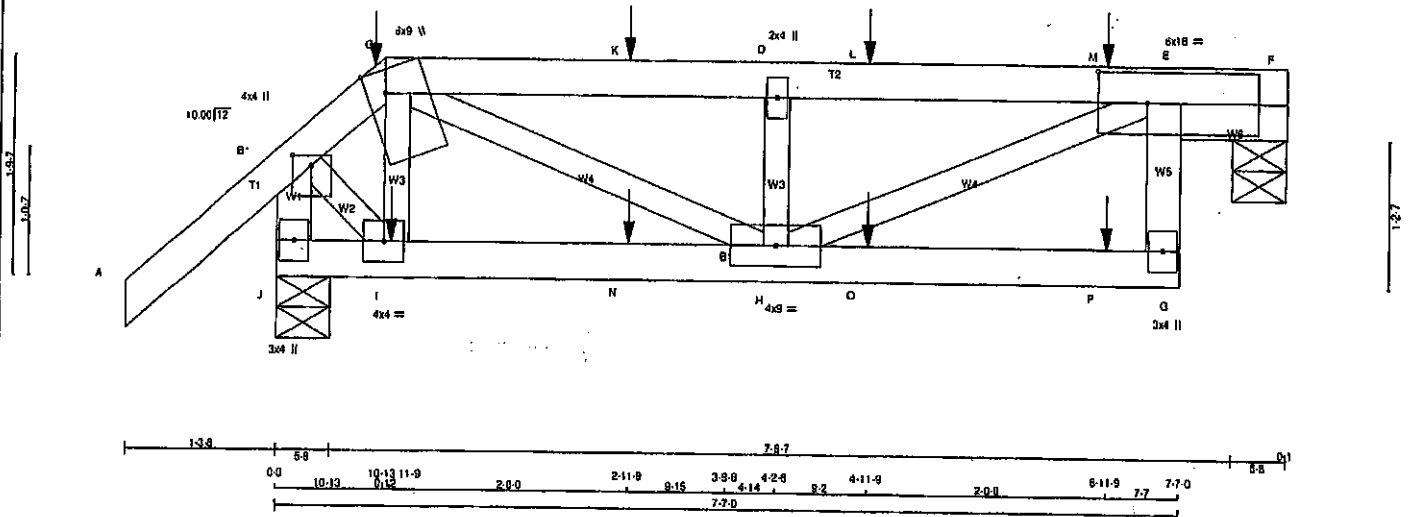

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2	
O - F	2x4	DRY	No.2	
E - F	2x4	DRY	No.2	
G - E	2x4	DRY	No.2	
J - B	2x4	DRY	No.2	
J - G	2x4	DRY	No.2	

ALL WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTWW+m	MT20	8.0	9.0	Edge	1.75
D	TMVW-w	MT20	2.0	4.0		
E	TMVWW-t	MT20	6.0	16.0	3.00	5.00
G	BMV+p	MT20	3.0	4.0		
H	BMVWW-t	MT20	4.0	9.0		
I	BMVW-t	MT20	4.0	4.0		
J	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERY	HORZ	DOWN	HORZ
F	655	0	895	0
J	936	0	936	0

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): F

UNFACTORED REACTIONS

1ST CASE	MAX./MIN. COMPONENT REACTIONS	1ST CASE	MAX./MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
F	490	327 / 0	0 / 0
J	659	449 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO									
A-B	0 / 41	-91.8	-91.8	0.14 (1)	10.00	10.00	10.00	10.00	10.00
B-C	-856 / 0	-91.8	-91.8	0.14 (1)	8.25	8.25	8.25	8.25	8.25
C-K	-1230 / 0	-91.8	-91.8	0.46 (1)	5.09	5.09	5.09	5.09	5.09
K-D	-1230 / 0	-91.8	-91.8	0.46 (1)	5.09	5.09	5.09	5.09	5.09
D-L	-1230 / 0	-91.8	-91.8	0.89 (1)	3.58	3.58	3.58	3.58	3.58
L-M	-1230 / 0	-91.8	-91.8	0.89 (1)	3.58	3.58	3.58	3.58	3.58
M-E	-1230 / 0	-91.8	-91.8	0.89 (1)	3.58	3.58	3.58	3.58	3.58
E-F	0 / 0	-91.8	-91.8	0.35 (1)	10.00	10.00	10.00	10.00	10.00
G-E	0 / 83	0.0	0.0	0.02 (4)	10.00	10.00	10.00	10.00	10.00
J-B	-966 / 0	0.0	0.0	0.11 (1)	7.81	7.81	7.81	7.81	7.81
J-I	0 / 0	-18.5	-18.5	0.06 (1)	10.00	10.00	10.00	10.00	10.00
I-N	0 / 438	-18.5	-18.5	0.14 (1)	10.00	10.00	10.00	10.00	10.00
N-H	0 / 438	-18.5	-18.5	0.14 (1)	10.00	10.00	10.00	10.00	10.00
H-O	0 / 0	-18.5	-18.5	0.09 (1)	10.00	10.00	10.00	10.00	10.00
O-P	0 / 0	-18.5	-18.5	0.09 (1)	10.00	10.00	10.00	10.00	10.00
P-G	0 / 0	-18.5	-18.5	0.09 (1)	10.00	10.00	10.00	10.00	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LOC.	MAX-	MAX+	FACE	O/R.	TYPE	HEEL	CONN.
C	10-13	-9	-10		FRONT	VERT	DEAD		C1
C	10-13	-90	-90		FRONT	VERT	TOTAL		C1
C	10-13	-44	-44		FRONT	VERT	SNOW		C1
I	11-9	-48	-48		FRONT	VERT	TOTAL		C1
K	2-11-9	-82	-82		FRONT	VERT	TOTAL		C1
L	4-11-9	-82	-82		FRONT	VERT	TOTAL		C1
M	6-11-9	-82	-82		FRONT	VERT	TOTAL		C1
N	2-11-9	-49	-49		FRONT	VERT	TOTAL		C1
O	4-11-9	-49	-49		FRONT	VERT	TOTAL		C1
P	6-11-9	-53	-53		FRONT	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 32 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.25")
CALCULATED VERT. DEFL. (LL) = L/999 (0.07")
ALLOWABLE DEFL. (TL) = L/360 (0.25")
CALCULATED VERT. DEFL. (TL) = L/688 (0.13")

CSI: TO=0.89/1.00 (D-E:1), BC=0.14/1.00 (H:1:1), WB=0.33/1.00 (E-H:1), SSI=0.42/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1686

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.79 (C) (INPUT = 0.90)
JSI METAL= 0.30 (H) (INPUT = 1.00)

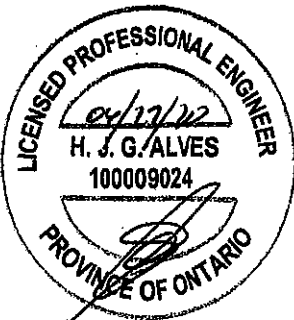


Structural component only
DWG# T-2007142

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408169	T20	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:24 2020 Page 1
ID:K?TPdhg0npl1qYdbWIOFzIdeG-18tgaan1sB7_Budbz0zKub4B8zN_xr0MZbH0gzNB0f

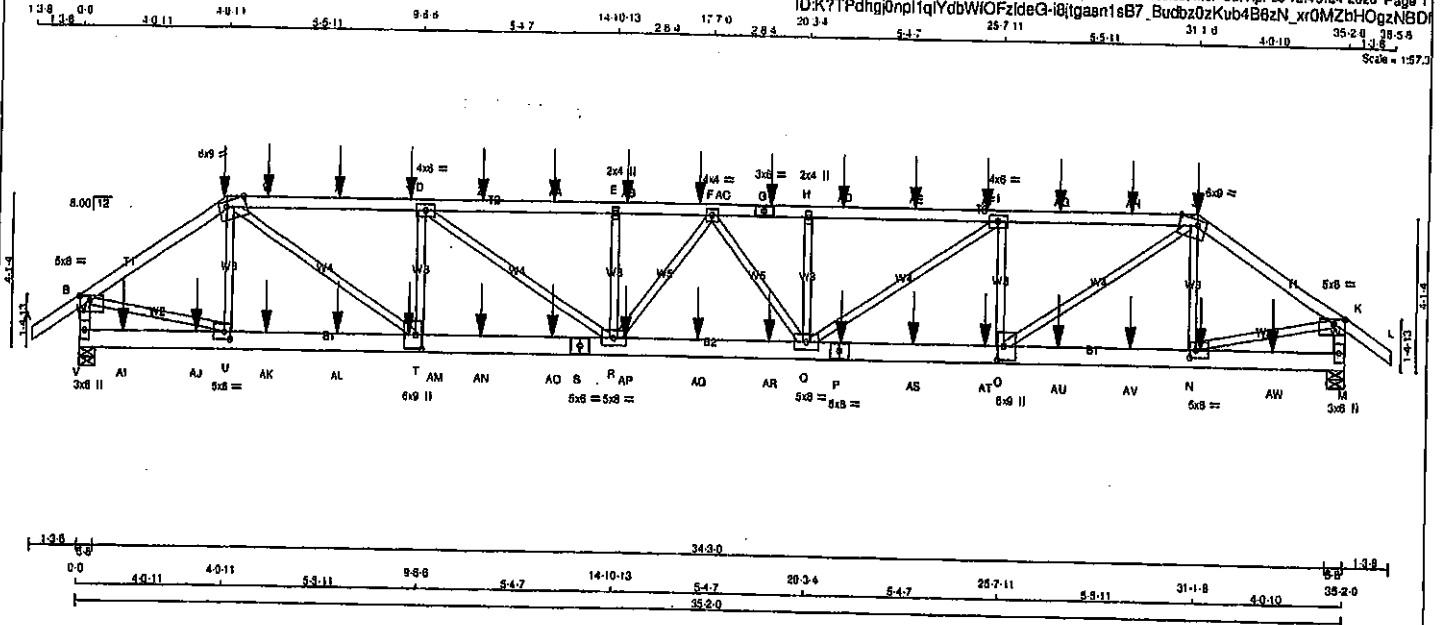

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - G	2x4	DRY	No.2	SPF	
G - J	2x4	DRY	No.2	SPF	
J - L	2x4	DRY	No.2	SPF	
V - B	2x4	DRY	No.2	SPF	
M - K	2x4	DRY	No.2	SPF	
S - P	2x8	DRY	No.2	SPF	
P - M	2x8	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY, SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE(81.0)
C - G	12	SIDE(81.0)
G - J	12	SIDE(81.0)
J - L	12	SIDE(81.0)
V - B	12	TOP
M - K	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
V - S	12	SIDE(183.1)
S - P	12	SIDE(183.1)
P - M	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	0	0
V	3342	0	0	5-8
M	3393	0	0	5-8

UNFACTORED REACTIONS

1ST LOSE	MAX./MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERMLIVE	WIND	DEAD	SOIL
V	2383	1595 / 0	0 / 0	0 / 0	0 / 0	808 / 0	0 / 0
M	2397	1595 / 0	0 / 0	0 / 0	0 / 0	812 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO						FR-TO			
A-B	0 / 35	-91.8	-91.8	0.07 (1)	10.00	U-C	-598 / 0	0.08 (1)	
B-C	-3851 / 0	-91.8	-91.8	0.22 (1)	4.58	C-T	0 / 3530	0.44 (1)	
C-W	-8186 / 0	-91.8	-91.8	0.61 (1)	3.41	T-D	-1829 / 0	0.23 (1)	
W-X	-8186 / 0	-91.8	-91.8	0.61 (1)	3.41	D-R	0 / 1602	0.20 (1)	
X-Y	-8186 / 0	-91.8	-91.8	0.61 (1)	3.41	R-E	-602 / 0	0.08 (1)	
Y-D	-8186 / 0	-91.8	-91.8	0.61 (1)	3.41	E-H	-598 / 0	0.08 (1)	
D-Z	-7502 / 0	-91.8	-91.8	0.71 (1)	3.03	H-I	0 / 1573	0.19 (1)	
Z-AA	-7502 / 0	-91.8	-91.8	0.71 (1)	3.03	I-J	-1808 / 0	0.23 (1)	
AA-E	-7502 / 0	-91.8	-91.8	0.71 (1)	3.03	J-K	0 / 3493	0.43 (1)	
E-AB	-7502 / 0	-91.8	-91.8	0.35 (1)	3.33	K-L	-616 / 0	0.08 (1)	
AB-AC	-7502 / 0	-91.8	-91.8	0.35 (1)	3.33	L-U	0 / 3374	0.42 (1)	
AC-F	-7502 / 0	-91.8	-91.8	0.35 (1)	3.33	U-K	0 / 3493	0.43 (1)	
F-G	-7509 / 0	-91.8	-91.8	0.37 (1)	3.31	R-F	-179 / 0	0.03 (1)	
G-H	-7509 / 0	-91.8	-91.8	0.37 (1)	3.31	F-Q	-188 / 0	0.03 (1)	
H-AD	-7509 / 0	-91.8	-91.8	0.71 (1)	3.03				
AD-AE	-7509 / 0	-91.8	-91.8	0.71 (1)	3.03				
AE-AF	-7509 / 0	-91.8	-91.8	0.71 (1)	3.03				
AF-I	-7509 / 0	-91.8	-91.8	0.71 (1)	3.03				
I-AG	-8217 / 0	-91.8	-91.8	0.61 (1)	3.41				
AG-AH	-8217 / 0	-91.8	-91.8	0.61 (1)	3.41				
AH-J	-8217 / 0	-91.8	-91.8	0.61 (1)	3.41				
J-K	-4026 / 0	-91.8	-91.8	0.22 (1)	4.55				
K-L	0 / 35	-91.8	-91.8	0.07 (1)	10.00				
V-B	-3298 / 0	0.0	0.0	0.18 (1)	6.41				
M-K	-3356 / 0	0.0	0.0	0.18 (1)	6.38				

V-AI	0 / 0	-18.5	-18.5	0.05 (4)	10.00
AI-AJ	0 / 0	-18.5	-18.5	0.05 (4)	10.00
AJ-U	0 / 0	-18.5	-18.5	0.05 (4)	10.00
U-AK	0 / 3285	-18.5	-18.5	0.25 (1)	10.00
AK-AL	0 / 3285	-18.5	-18.5	0.25 (1)	10.00
AL-AM	0 / 3285	-18.5	-18.5	0.25 (1)	10.00
AM-T	0 / 3285	-18.5	-18.5	0.25 (1)	10.00
T-AN	0 / 8186	-18.5	-18.5	0.48 (1)	10.00
AN-AO	0 / 8186	-18.5	-18.5	0.48 (1)	10.00
AO-S	0 / 8186	-18.5	-18.5	0.48 (1)	10.00
S-R	0 / 8186	-18.5	-18.5	0.48 (1)	10.00
R-AP	0 / 7808	-18.5	-18.5	0.58 (1)	10.00
AP-AQ	0 / 7808	-18.5	-18.5	0.58 (1)	10.00
AQ-AR	0 / 7808	-18.5	-18.5	0.58 (1)	10.00
AR-Q	0 / 7808	-18.5	-18.5	0.58 (1)	10.00
Q-P	0 / 8217	-18.5	-18.5	0.48 (1)	10.00
P-S	0 / 8217	-18.5	-18.5	0.48 (1)	10.00

TOTAL WEIGHT = 2 X 180 = 321 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL. USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2010, NBCO 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCO 2010, NBCO 2012, ABC 2019
- PART 9 OF NBCO 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.23")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/984 (0.44")

CSI: TC=0.71/1.00 (D-E:1), BC=0.56/1.00 (Q-R:1),
WB=0.44/1.00 (C-T:1), SS=0.23/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 816 354 1887 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.71 (3) (INPUT = 0.90)
JSI METAL= 0.59 (5) (INPUT = 1.00)

CONTINUED ON PAGE 2

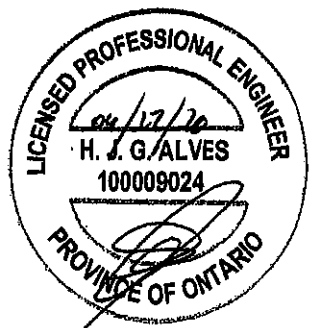

Structural component only
DWG# T-2007145 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408169	T20	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:24 2020 Page 2
ID:K7TPdHg0nptglYobWIOFzIdeG-IBltgean1sB7 Budbz0zKub4B8zN xqQMZbHOGzNBDr

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.50	3.50
C	TTWW-m	MT20	6.0	9.0	Edge	6.25
D	TMVW-l	MT20	4.0	6.0		
E	TMVW-w	MT20	2.0	4.0		
F	TMVW-l	MT20	4.0	4.0		
G	T8-l	MT20	3.0	6.0		
H	TMVW-w	MT20	2.0	4.0		
I	TMVW-l	MT20	4.0	6.0		
J	TTWW-m	MT20	6.0	9.0	Edge	6.25
K	TMVW-p	MT20	5.0	8.0	1.50	3.50
M	BMV1-p	MT20	3.0	6.0		
N	BMVW-l	MT20	5.0	6.0	2.50	2.00
O	BMVW-l	MT20	8.0	9.0	4.50	2.00
P	BS-l	MT20	5.0	8.0		
Q	BMVW-w-l	MT20	5.0	8.0		
R	BMVW-w-l	MT20	5.0	8.0		
S	BS-l	MT20	5.0	8.0		
T	BMVW-l	MT20	8.0	9.0	4.50	2.00
U	BMVW-l	MT20	5.0	8.0	2.50	2.00
V	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. FACTORED CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED CS1 (LC)
FR-TO		FROM	TO		UNBRAC		LENGTH FR-TO
AS-AT	0 / 6217	-18.5	-18.5	0.46 (1)	10.00		
AT-O	0 / 6217	-18.5	-18.5	0.46 (1)	10.00		
O-AU	0 / 3328	-18.5	-18.5	0.26 (1)	10.00		
AU-AV	0 / 3328	-18.5	-18.5	0.26 (1)	10.00		
AV-N	0 / 3328	-18.5	-18.5	0.26 (1)	10.00		
N-AW	0 / 0	-18.5	-18.5	0.04 (4)	10.00		
AW-M	0 / 0	-18.5	-18.5	0.04 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-11	-49	-55	FRONT	VERT	DEAD	---	C1
C	4-0-11	-284	-254	FRONT	VERT	SNOW	---	C1
G	19-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
J	31-1-8	-49	-55	FRONT	VERT	DEAD	---	C1
J	31-1-8	-117	-117	BACK	VERT	TOTAL	---	C1
J	31-1-8	-254	-254	FRONT	VERT	SNOW	---	C1
N	31-2-12	-28	-26	BACK	VERT	TOTAL	---	C1
P	21-2-12	-28	-26	BACK	VERT	TOTAL	---	C1
W	5-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
X	7-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
Y	9-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
Z	11-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
AA	13-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
AB	15-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
AO	17-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
AD	21-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
AE	23-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
AF	25-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
AG	27-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
AH	29-2-12	-110	-110	BACK	VERT	TOTAL	---	C1
AI	1-2-12	-28	-26	BACK	VERT	TOTAL	---	C1
AJ	3-2-12	-28	-26	BACK	VERT	TOTAL	---	C1
AK	5-2-12	-28	-26	BACK	VERT	TOTAL	---	C1
AL	7-2-12	-28	-26	BACK	VERT	TOTAL	---	C1
AM	9-2-12	-28	-26	BACK	VERT	TOTAL	---	C1
AN	11-2-12	-28	-26	BACK	VERT	TOTAL	---	C1
AO	13-2-12	-28	-26	BACK	VERT	TOTAL	---	C1
AP	15-2-12	-28	-26	BACK	VERT	TOTAL	---	C1
AQ	17-2-12	-28	-26	BACK	VERT	TOTAL	---	C1
AR	19-2-12	-28	-26	BACK	VERT	TOTAL	---	C1
AS	23-2-12	-28	-26	BACK	VERT	TOTAL	---	C1
AT	25-2-12	-28	-26	BACK	VERT	TOTAL	---	C1
AU	27-2-12	-28	-26	BACK	VERT	TOTAL	---	C1
AV	29-2-12	-28	-26	BACK	VERT	TOTAL	---	C1
AW	33-2-12	-28	-26	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007145

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T20Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:25 2020 Page 1
 ID:K7TPdghj0npl1qYdbWIOFzideG-AKHFWuP09K_cKTp9pXCi67DKWF2Jk9bCKqW7zNBDe
 1.38 0.0 13.8 4.0-11 5.5-11 9.6-6 5.4-7 14-10-13 2.8-4 20-3-4 5.4-7 29-7-11 27-6-12 29-4-12 31-1-6 31-6-12 35-2-0 35-5-8
 Scale = 1/57.3

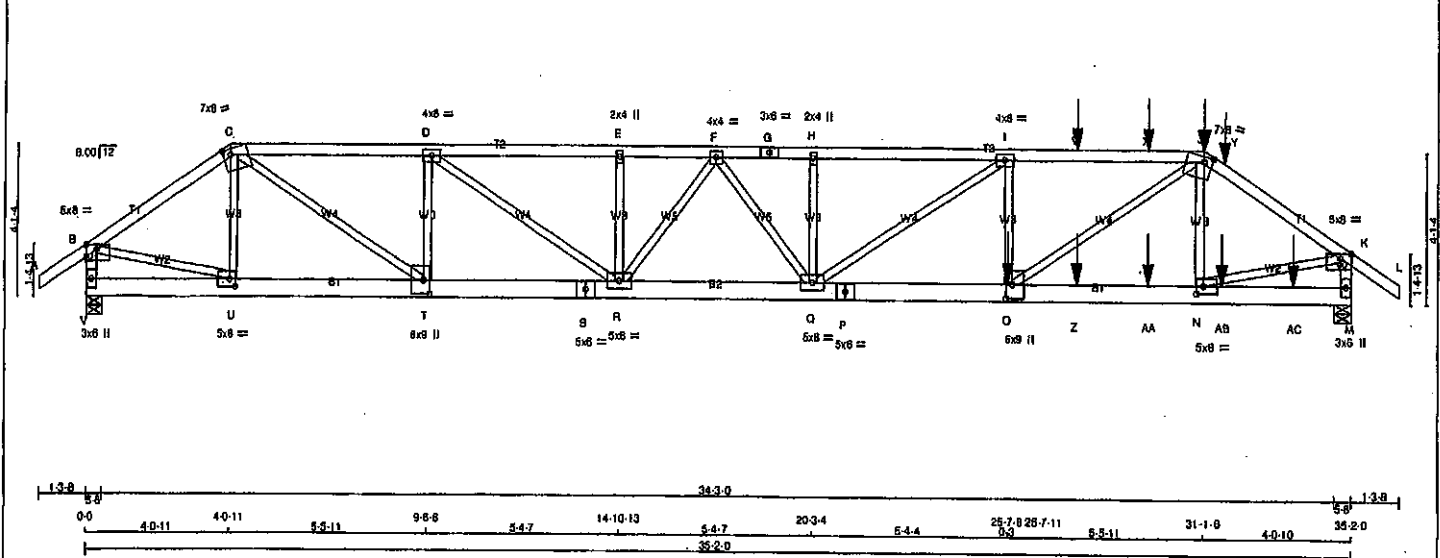

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
J - L	2x4	DRY	No.2
V - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
V - S	2x6	DRY	No.2
S - P	2x6	DRY	No.2
P - M	2x6	DRY	No.2

ALL WEBS 2x3 DRY No.2
 EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	12	TOP
C-G	12	TOP
G-J	12	TOP
J-L	12	TOP
V-B	12	TOP
M-K	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
V-S	12	TOP
S-P	12	TOP
P-M	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	8	TOP
I-O	3	TOP
D-T	3	TOP

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
V	2938	0	2938	0
M	4788	0	4788	0

UNFACTORED REACTIONS	1ST LOASE	MAX/MIN	COMPONENT REACTIONS
	COMBINED	SNOW	LIVE
JT	2073	1388 / 0	0 / 0
V	2073	1388 / 0	0 / 0
M	3381	2278 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.57 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	MEMB.	FORCE
	(LBS)	(PLF)		(LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 / 35	-91.8 -91.8	U-C	-584 / 0
B-C	-3442 / 0	-91.8 -91.8	C-T	0 / 3700
C-D	-5805 / 0	-91.8 -91.8	T-D	-1983 / 0
D-E	-7847 / 0	-91.8 -91.8	D-R	0 / 2485
E-F	-7847 / 0	-91.8 -91.8	R-E	-388 / 0
F-G	-9222 / 0	-91.8 -91.8	Q-H	-348 / 0
G-H	-9222 / 0	-91.8 -91.8	H-Q	-503 / 0
H-I	-9222 / 0	-91.8 -91.8	I-Q	-397 / 0
I-W	-9835 / 0	-91.8 -91.8	Q-J	0 / 5776
W-X	-9835 / 0	-91.8 -91.8	J-N	-915 / 0
X-J	-9835 / 0	-91.8 -91.8	N-U	0 / 2840
J-Y	-5847 / 0	-91.8 -91.8	U-B	0 / 5020
Y-K	-5847 / 0	-91.8 -91.8	B-K	-1209 / 0
K-L	0 / 35	-91.8 -91.8	R-F	0 / 974
V-B	-2814 / 0	0.0 0.0	F-Q	0 / 974
M-K	-4771 / 0	0.0 0.0		

FACTORED CONCENTRATED LOADS (LBS)	LOC.	LG1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
JT	31-1-6	-49	-55	---	FRONT	VERT	DEAD	---	C1
J	31-1-6	-254	-254	---	FRONT	VERT	SNOW	---	C1
O	25-7-8	-2840	-2840	---	FRONT	VERT	TOTAL	---	C1
W	27-6-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	29-4-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	31-6-12	-138	-138	---	FRONT	VERT	TOTAL	---	C1
Z	27-6-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AA	29-4-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AB	31-6-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AC	33-6-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
 GEOMETRY AND/OR BASIC LOADS CHANGED BY USER
 LOADS WERE DERIVED FROM USER INPUT
 NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***
 ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBCC 2010, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
 CALCULATED VERT. DEFL. (LL) = L/998 (0.28")
 ALLOWABLE DEFL. (TL) = L/360 (1.17")
 CALCULATED VERT. DEFL. (TL) = L/832 (0.51")

CSI: TC=0.88/1.00 (I-J:1), BC=0.72/1.00 (O-Q:1),
 WB=0.71/1.00 (J-O:1), SS=0.18/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP (ORY) SHEAR SECTION
 (PSI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1067 788 1987 1686

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (C) (INPUT = 0.80)
 JSI METAL = 0.87 (S) (INPUT = 1.00)



Structural component only
 DWG# T-2007146 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T20Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 12:48:25 2020 Page 2
ID:K?TPdha0nplqlyobWIOFzIdeG-AKHFWitPo9K ckTp9aXCi67DKWF2iuk9bCKqw7zNBDe

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.50	3.50
C	TTWW-m	MT20	7.0	8.0	1.75	2.50
D	TMWW-t	MT20	4.0	6.0		
E	TMW-w	MT20	2.0	4.0		
F	TMWW-t	MT20	4.0	4.0		
G	TS-t	MT20	3.0	6.0		
H	TMW-w	MT20	2.0	4.0		
I	TMWW-t	MT20	4.0	6.0		
J	TTWW-m	MT20	7.0	8.0	1.75	2.50
K	TMVW-p	MT20	6.0	8.0	1.50	3.50
M	BMV1-p	MT20	3.0	6.0		
N	BMWW-t	MT20	5.0	8.0	2.50	2.00
O	BMWW-t	MT20	8.0	9.0	4.50	2.00
P	BS-t	MT20	5.0	6.0		
Q	BMWW-t	MT20	6.0	8.0		
R	BMWW-t	MT20	5.0	8.0		
S	BS-t	MT20	6.0	6.0		
T	BMWW-t	MT20	6.0	9.0	4.50	2.00
U	BMWW-t	MT20	5.0	8.0	2.50	2.00
V	BMV1-p	MT20	3.0	6.0		

CONNECTION REQUIREMENTS


- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007146 42

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T21	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 26 12:49:26 2020 Page 1
ID:K?TPdhg0npl1qYdbWIOFzIdeG-eWrdSGiZTSrDU1QjO2RPJgONwdaSrJps4OSZzNBDD

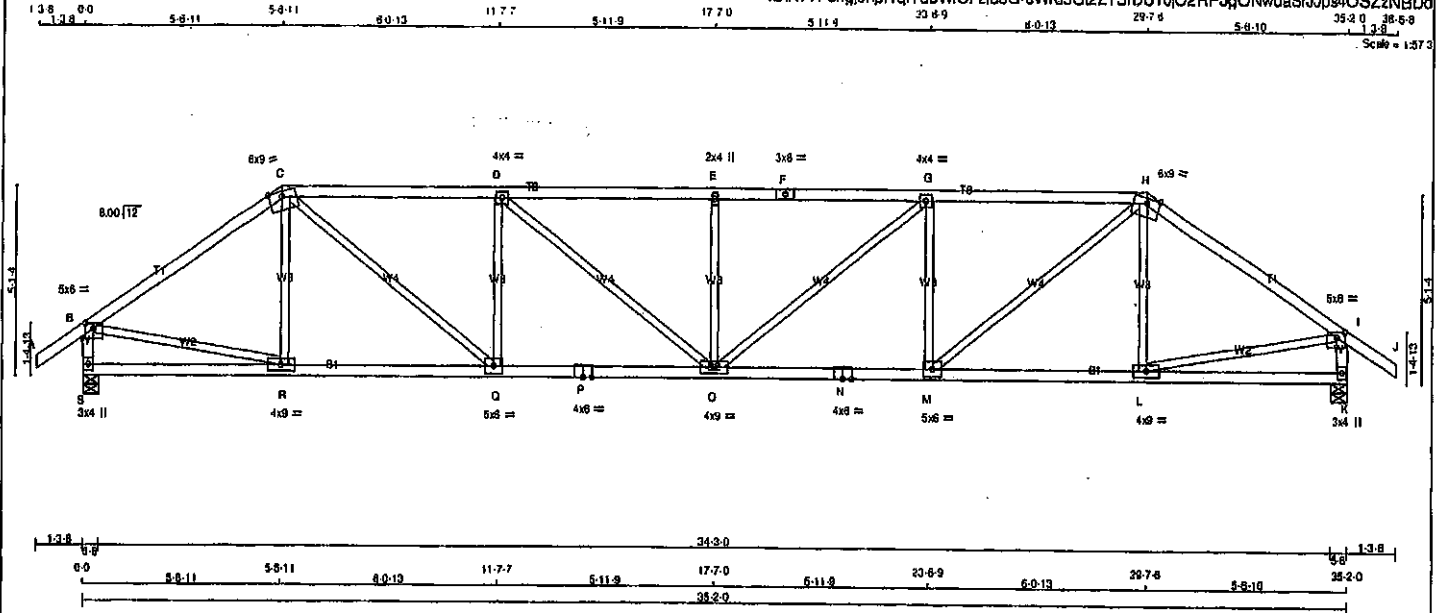

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				TOTAL WEIGHT = 2 X 140 = 280 lb			
N. L. G. A. RULES				BEARINGS				DESIGN CRITERIA			
CHORDS	SIZE	LUMBER	DESCR.	FACTORED	MAXIMUM FACTORED	INPUT	RECORD	SPECIFIED LOADS:			
A - C	2x4	DRY	No.2	SPF	GROSS REACTION	GROSS REACTION	BRG	TOP CH. LL = 25.6 PSF			
C - F	2x4	DRY	No.2	SPF	JT VERT	HORZ	UPLIFT	DL = 6.0 PSF			
F - H	2x4	DRY	No.2	SPF	S 2065	0	0	BOT CH. LL = 0.0 PSF			
H - J	2x4	DRY	No.2	SPF	K 2065	0	0	DL = 7.4 PSF			
S - B	2x4	DRY	No.2	SPF				TOTAL LOAD = 39.0 PSF			
K - I	2x4	DRY	No.2	SPF				SPACING = 24.0 IN. O.C.			
S - P	2x4	DRY	No.2	SPF				LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12			
P - N	2x4	DRY	No.2	SPF				THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015			
N - K	2x4	DRY	No.2	SPF				THIS DESIGN COMPLIES WITH:			
ALL WEBS	2x3	DRY	No.2	SPF				- PART 9 OF CBC 2018, CBC 2012, ABC 2019			
EXCEPT								- PART 9 OF CBC 2012 (2019 AMENDMENT)			
DRY: SEASONED LUMBER.				BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K				- CSA 084-09, CSA 088-14			
				BRACING				- TPIC 2011, TPIC 2014			
				LOADING				(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD			
				ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.				ALLOWABLE DEFL.(LL) = L/960 (1.17')			
				TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.97 FT.				CALCULATED VERT. DEFL.(LL) = L/999 (0.21')			
				MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.				ALLOWABLE DEFL.(TL) = L/960 (1.17')			
				ALL LOAD CASES: (4)				CALCULATED VERT. DEFL.(TL) = L/999 (0.39')			

PLATES (table is in inches)			
JT TYPE	PLATES	W	LEN Y X
B TMW-p	MT20	5.0	6.0 1.75 2.75
C TTWW-m	MT20	6.0	9.0 Edge
D TMWW-l	MT20	4.0	4.0
E TMWW-w	MT20	2.0	4.0
F TS-l	MT20	3.0	4.0
G TMWW-l	MT20	4.0	4.0
H TTWW-m	MT20	6.0	9.0 Edge
I TMWW-p	MT20	5.0	6.0 1.75 2.75
K BMW-l+p	MT20	3.0	4.0
L BMWW-l	MT20	4.0	9.0
M BMWW-l	MT20	5.0	6.0
N BS-l	MT20	4.0	6.0
O BMWW-l	MT20	4.0	9.0
P BS-l	MT20	4.0	6.0
Q BMWW-l	MT20	5.0	6.0
R BMWW-l	MT20	4.0	9.0
S BMW-l+p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.




Structural component only
DWG# T-2007147

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T22	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:27 2020 Page 1

ID:K?TPdng0npl1qIYdbWIOFzIdG-6jO7JbugKnairecCH5ZgyXDemJ7DB0HS2Wpx??7zNBDC

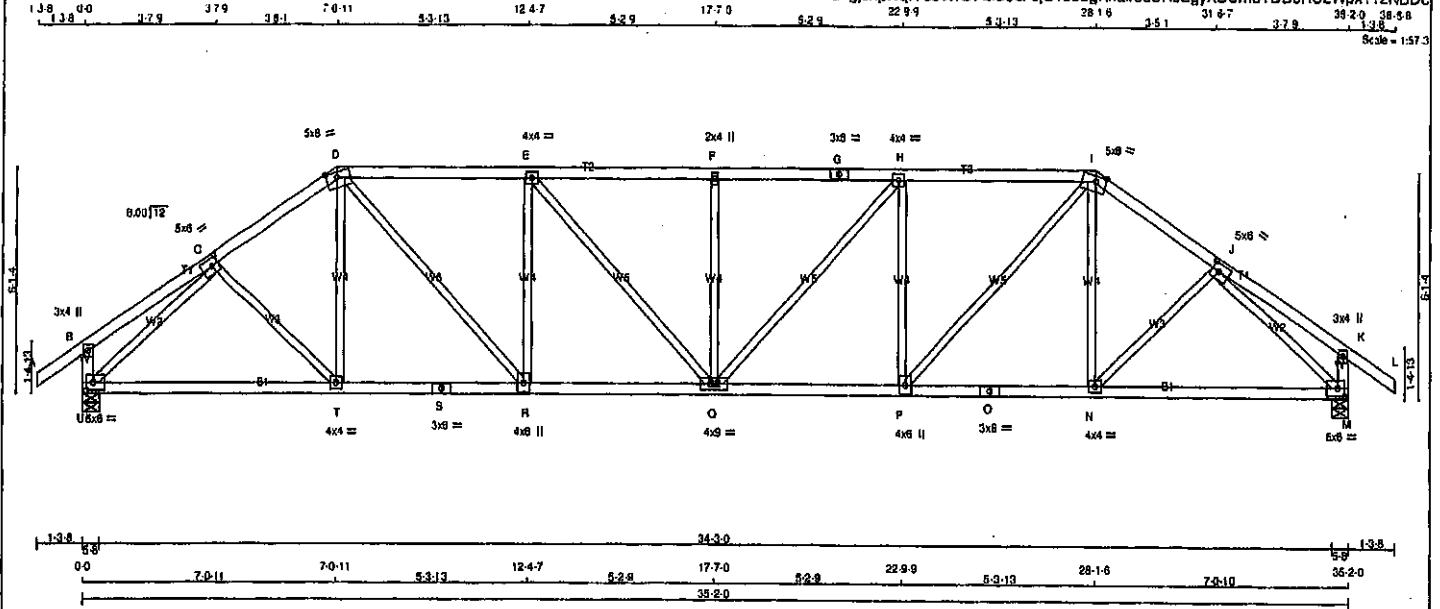

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - G	2x4	DRY No.2	SPF
G - I	2x4	DRY No.2	SPF
I - L	2x4	DRY No.2	SPF
U - B	2x4	DRY No.2	SPF
M - K	2x4	DRY No.2	SPF
U - S	2x4	DRY No.2	SPF
S - O	2x4	DRY No.2	SPF
O - M	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			

DRY: SEASONED LUMBER.

PLATE TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMWV-t	MT20	5.0	6.0	2.50	2.50
D TTWV-m	MT20	5.0	8.0	1.75	3.50
E TMWV-t	MT20	4.0	4.0		
F TMWV-w	MT20	2.0	4.0		
G TS-t	MT20	3.0	8.0		
H TMWV-t	MT20	4.0	4.0		
I TTWV-m	MT20	5.0	8.0	1.75	3.50
J TMWV-t	MT20	5.0	8.0	2.50	2.50
K TMV+p	MT20	3.0	4.0		
M BMWV-t	MT20	5.0	6.0	2.50	2.25
N BMWV-t	MT20	4.0	4.0		
O BS-t	MT20	3.0	6.0		
P BMWV-t	MT20	4.0	6.0		
Q BMWV-t	MT20	4.0	6.0		
R BMWV-t	MT20	4.0	6.0		
S BS-t	MT20	3.0	6.0		
T BMWV-t	MT20	4.0	4.0		
U BMWV-t	MT20	5.0	6.0	2.50	2.25

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	HORZ	DOWN	HORZ
U	2065	0	0
M	2065	0	0

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW
U	1458	970 / 0
M	1458	970 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.53 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	FORCE	VERT. LOAD	LC1	MAX	CS1 (LC)	UNBRAC	LENGTH	FR-TO	MEMB.	MAX. FACTORED	FORCE	MAX	CS1 (LC)
A-B	0 / 35	-91.8	-91.8	0.12	(1)	10.00	C-T	0 / 135	0.03 (4)						
B-C	0 / 18	-91.8	-91.8	0.16	(1)	10.00	D-T	0 / 80	0.03 (4)						
C-D	-2305 / 0	-91.8	-91.8	0.23	(1)	4.31	D-R	0 / 1218	0.27 (1)						
D-E	-2723 / 0	-91.8	-91.8	0.54	(1)	3.69	E-R	-814 / 0	0.48 (1)						
E-F	-2988 / 0	-91.8	-91.8	0.66	(1)	3.53	E-Q	0 / 383	0.08 (1)						
F-G	-2988 / 0	-91.8	-91.8	0.66	(1)	3.53	Q-F	-440 / 0	0.28 (1)						
G-H	-2988 / 0	-91.8	-91.8	0.66	(1)	3.53	Q-H	0 / 383	0.08 (1)						
H-I	-2723 / 0	-91.8	-91.8	0.54	(1)	3.69	P-H	-814 / 0	0.48 (1)						
I-J	-2305 / 0	-91.8	-91.8	0.23	(1)	4.31	P-I	0 / 1218	0.27 (1)						
J-K	0 / 18	-91.8	-91.8	0.16	(1)	10.00	N-I	0 / 90	0.03 (4)						
K-L	0 / 35	-91.8	-91.8	0.12	(1)	10.00	N-J	0 / 135	0.03 (4)						
U-B	-255 / 0	0.0	0.0	0.03	(1)	7.81	U-C	-2515 / 0	0.97 (1)						
M-K	-255 / 0	0.0	0.0	0.03	(1)	7.81	J-M	-2515 / 0	0.97 (1)						
U-T	0 / 1802	-18.5	-18.5	0.40	(1)	10.00									
T-S	0 / 1801	-18.5	-18.5	0.41	(1)	10.00									
S-R	0 / 1901	-18.5	-18.5	0.41	(1)	10.00									
R-Q	0 / 2724	-18.5	-18.5	0.49	(1)	10.00									
Q-P	0 / 2723	-18.5	-18.5	0.49	(1)	10.00									
P-O	0 / 1900	-18.5	-18.5	0.41	(1)	10.00									
O-N	0 / 1900	-18.5	-18.5	0.41	(1)	10.00									
N-M	0 / 1801	-18.5	-18.5	0.40	(1)	10.00									

TOTAL WEIGHT = 2 X 151 = 303 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/G

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/380 (1.17)
CALCULATED VERT. DEFL. (LL) = L/999 (0.16")
ALLOWABLE DEFL. (TL) = L/380 (1.17)
CALCULATED VERT. DEFL. (TL) = L/999 (0.28")

CS1: TC=0.56/1.00 (E-F:1), BC=0.48/1.00 (Q-R:1), WB=0.97/1.00 (C-U:1), SS=0.23/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1887 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.90 (M) (INPUT = 0.90)
JSI METAL= 0.63 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007148

JOB NAME 408169	TRUSS NAME T23	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:28 2020 Page 1
ID:K?7TPdhgJ0npl1qIYdbWOFzIdeG-bvYvNWxvI54IZToBQqp4vVkinEJLmwjVbHAZVXRzNBDb

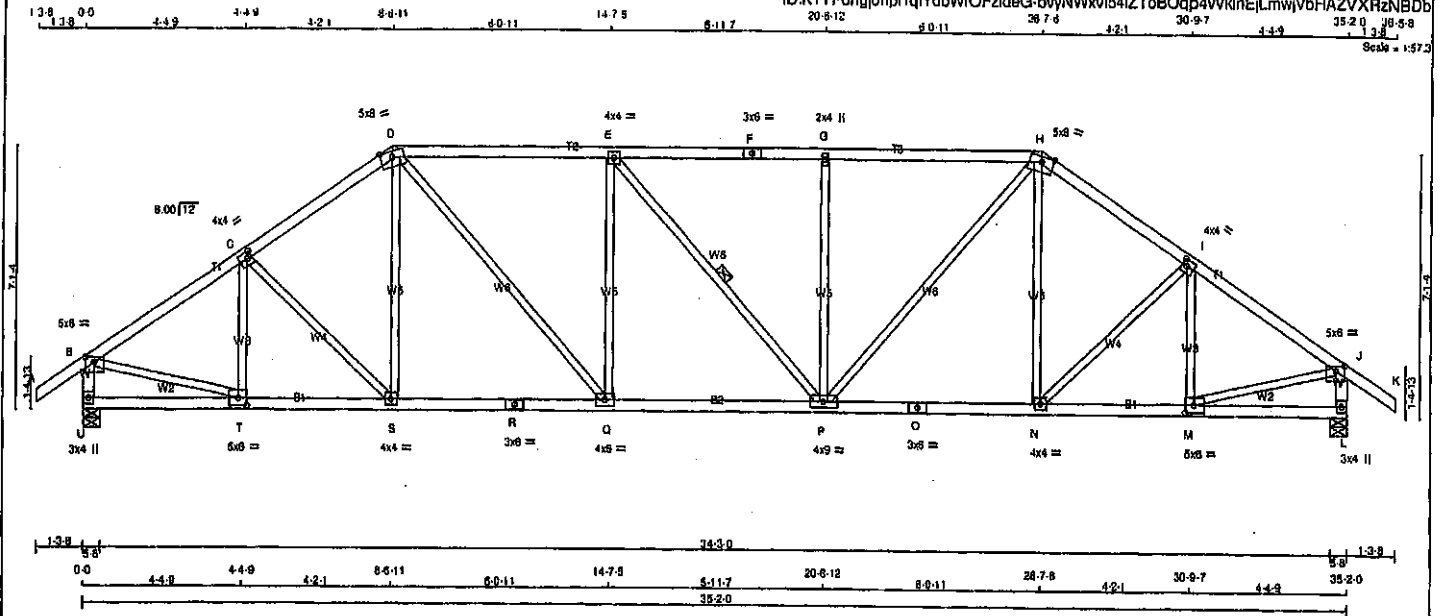

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.75	2.75
C	TMVW-l	MT20	4.0	4.0	2.00	1.50
D	TTVW-m	MT20	5.0	8.0	Edge	
E	TMVW-l	MT20	4.0	4.0		
F	TS-l	MT20	3.0	6.0		
G	TMVW-w	MT20	2.0	4.0		
H	TTVW-m	MT20	5.0	8.0	Edge	
I	TMVW-l	MT20	4.0	4.0	2.00	1.50
J	TMVW-p	MT20	5.0	8.0	1.75	2.75
L	BMV1+p	MT20	3.0	4.0		
M	BMVW-l	MT20	5.0	8.0	2.50	2.75
N	BMVW-l	MT20	4.0	4.0		
O	BS-l	MT20	3.0	6.0		
P	BMVW-l	MT20	4.0	4.0		
Q	BMVW-l	MT20	4.0	4.0		
R	BS-l	MT20	3.0	6.0		
S	BMVW-l	MT20	4.0	4.0		
T	BMVW-l	MT20	5.0	8.0	2.50	2.75
U	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
U	2065	0	2065	0	5-8	5-8	
L	2065	0	2065	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
U	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E.P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8 -91.8	0.12 (1)	10.00	T-C	-398 / 0	0.11 (1)
B-C	-2270 / 0	-91.8 -91.8	0.37 (1)	4.19	C-S	-79 / 0	0.05 (1)
C-D	-2254 / 0	-91.8 -91.8	0.38 (1)	4.21	S-D	0 / 156	0.04 (4)
D-E	-2485 / 0	-91.8 -91.8	0.64 (1)	3.72	Q-Q	0 / 949	0.21 (1)
E-F	-2493 / 0	-91.8 -91.8	0.64 (1)	3.72	E-P	-597 / 0	0.52 (1)
F-G	-2493 / 0	-91.8 -91.8	0.64 (1)	3.72	P-Q	-2 / 0	0.00 (1)
G-H	-2493 / 0	-91.8 -91.8	0.63 (1)	3.74	P-Q	-596 / 0	0.52 (1)
H-I	-2254 / 0	-91.8 -91.8	0.38 (1)	4.21	P-H	0 / 947	0.21 (1)
I-J	-2269 / 0	-91.8 -91.8	0.37 (1)	4.19	N-H	0 / 157	0.06 (4)
J-K	0 / 35	-91.8 -91.8	0.12 (1)	10.00	N-I	-79 / 0	0.05 (1)
U-B	-2027 / 0	0.0 0.0	0.21 (1)	5.94	M-I	-397 / 0	0.11 (1)
L-J	-2028 / 0	0.0 0.0	0.21 (1)	5.94	B-T	0 / 1966	0.44 (1)
					M-J	0 / 1965	0.44 (1)
U-T	0 / 0	-18.5 -18.5	0.08 (4)	10.00			
T-S	0 / 1909	-18.5 -18.5	0.37 (1)	10.00			
S-R	0 / 1854	-18.5 -18.5	0.38 (1)	10.00			
R-Q	0 / 1854	-18.5 -18.5	0.38 (1)	10.00			
Q-P	0 / 2485	-18.5 -18.5	0.47 (1)	10.00			
P-O	0 / 1854	-18.5 -18.5	0.38 (1)	10.00			
O-N	0 / 1854	-18.5 -18.5	0.38 (1)	10.00			
N-M	0 / 1908	-18.5 -18.5	0.37 (1)	10.00			
M-L	0 / 0	-18.5 -18.5	0.08 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.64/1.00 (D-E:1), BC=0.47/1.00 (P-Q:1), WB=0.52/1.00 (E-Q:1), SS=0.26/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 816 354 1687 788 1887 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.90 (D) (INPUT = 0.90)
JSI METAL = 0.92 (D) (INPUT = 1.00)



Structural component only
DWG# T-2007149

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T24	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITak Industries, Inc. Sat Apr 25 12:49:29 2020 Page 1
ID:K7TPdghj0nph1qlYcbWOFzdeG-35WmkHwvsOqQ4ymbOWc81ylwH7ixBNWq123uzNBda

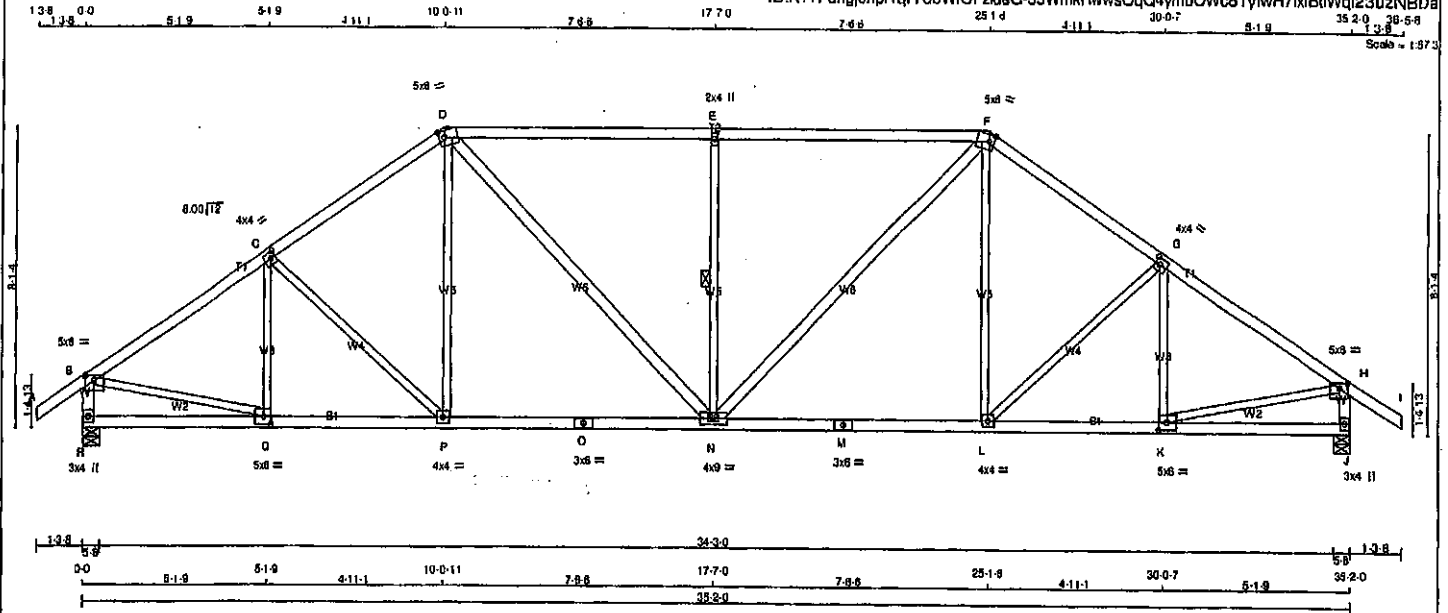

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
R - B	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
R - O	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
D - N	2x4	DRY	No.2	SPF	
N - F	2x4	DRY	No.2	SPF	

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.75	2.75	
C	TMVW-l	MT20	4.0	4.0	2.00	1.50	
D	TTWW-m	MT20	5.0	8.0	2.25	1.75	
E	TMVW-w	MT20	2.0	4.0			
F	TTWW-m	MT20	5.0	8.0	2.25	1.75	
G	TMVW-l	MT20	4.0	4.0	2.00	1.50	
H	TMVW-p	MT20	5.0	8.0	1.75	2.75	
J	BMV1+p	MT20	3.0	4.0			
K	BMVW-l	MT20	5.0	8.0	2.50	2.75	
L	BMVW-l	MT20	4.0	4.0			
M	BS-l	MT20	3.0	6.0			
N	BMVWVW-l	MT20	4.0	9.0			
O	BS-l	MT20	3.0	6.0			
P	BMVW-l	MT20	4.0	4.0			
Q	BMVW-l	MT20	5.0	8.0	2.50	2.75	
R	BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
R	2065	0	2065	0
J	2065	0	2065	0

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE	
R	1458	970 / 0	0 / 0	0 / 0	488 / 0
J	1458	970 / 0	0 / 0	0 / 0	488 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING	CHORDS	WEBS
TOTAL LOAD CASES: (4)	MAX. FACTORED	MAX. FACTORED
	MEMB. FORCE (LBS)	MEMB. FORCE (LBS)
FR-TO	FR-TO	FR-TO
A-B	0 / 35	-91.8
B-C	-2318 / 0	-91.8
C-D	-2186 / 0	-91.8
D-E	-2274 / 0	-91.8
E-F	-2274 / 0	-91.8
F-G	-2185 / 0	-91.8
G-H	-2317 / 0	-91.8
H-I	0 / 35	-91.8
R-B	-2022 / 0	0.0
J-H	-2022 / 0	0.0
R-Q	0 / 0	-18.5
O-P	0 / 1953	-18.5
P-O	0 / 1794	-18.5
O-N	0 / 1794	-18.5
N-M	0 / 1794	-18.5
M-L	0 / 1794	-18.5
L-K	0 / 1953	-18.5
K-J	0 / 0	-18.5

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 089-09, CSA 089-14
- TPIG 2011, TPIG 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN. LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.11')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.22')

CSI: TC=0.91/1.00 (D-E:1), BC=0.41/1.00 (N-P:1), WB=0.45/1.00 (B-C:1), SS=0.34/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (B) (INPUT = 0.90)
JSI METAL= 0.84 (M) (INPUT = 1.00)




Structural component only
DWG# T-2007150

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T25	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:30 2020 Page 1
ID:K7TPdhgJ0np1qYdbWIOFzIdG-KH8xdwYdlyHlNye7Na9q9dX2TOe3ukU2bbKzNBDZ

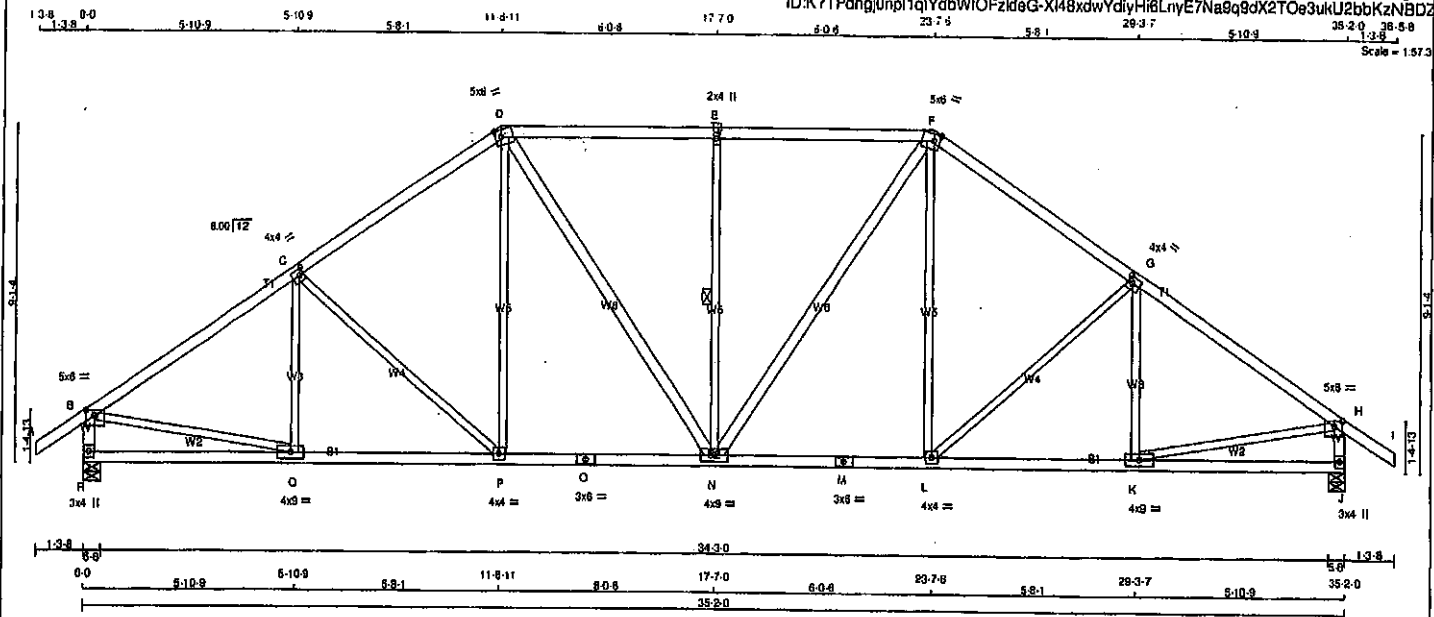

LUMBER				DESIGN CRITERIA			
N. L. G. A. RULES				SPECIFIED LOADS:			
CHORDS	SIZE	LUMBER	DESCR.	TOP CH.	LL	28.8	PSF
A - D	2x4	DRY	No.2	DL	6.0	PSF	
D - F	2x4	DRY	No.2	BOT CH.	LL	0.0	PSF
F - I	2x4	DRY	No.2	DL	7.4	PSF	
R - B	2x4	DRY	No.2	TOTAL LOAD		39.0	PSF
J - H	2x4	DRY	No.2				
R - O	2x4	DRY	No.2				
O - M	2x4	DRY	No.2				
M - J	2x4	DRY	No.2				
ALL WEBS 2x3 DRY No.2				SPACING = 24.0 IN. G.C.			
EXCEPT				LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12			
D - N	2x4	DRY	No.2	THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015			
N - F	2x4	DRY	No.2	THIS DESIGN COMPLES WITH:			

DRY: SEASONED LUMBER.				TOTAL WEIGHT = 2 X 165 = 329 lb			
-----------------------	--	--	--	---------------------------------	--	--	--

PLATES (table is in inches)				LOADING			
JT	TYPE	PLATES	W LEN Y X	TOTAL LOAD CASES: (4)			
B	TMWW-p	MT20	5.0 6.0 1.75 2.75	CHORDS			
C	TMWW-l	MT20	4.0 4.0 2.00 1.50	MAX. FACTORED			
D	TMWW-m	MT20	5.0 6.0 2.25 2.00	FORCE (LBS)			
E	TMWW-w	MT20	2.0 4.0	VERT. LOAD			
F	TMWW-m	MT20	5.0 6.0 2.25 2.00	FROM TO			
G	TMWW-l	MT20	4.0 4.0 2.00 1.50	MAX. FACTORED			
H	TMWW-p	MT20	5.0 6.0 1.75 2.75	FORCE (LBS)			
J	BMV1-p	MT20	3.0 4.0	FROM TO			
K	BMWW-l	MT20	4.0 9.0	MAX. FACTORED			
L	BMWW-l	MT20	4.0 4.0	FORCE (LBS)			
M	BS-l	MT20	3.0 6.0	FROM TO			
N	BMWW-l	MT20	4.0 9.0	MAX. FACTORED			
O	BS-l	MT20	3.0 6.0	FORCE (LBS)			
P	BMWW-l	MT20	4.0 4.0	FROM TO			
Q	BMWW-l	MT20	4.0 9.0	MAX. FACTORED			
R	BMV1-p	MT20	3.0 4.0	FORCE (LBS)			

ALL WEBS 2x3 DRY No.2				CHORDS			
EXCEPT				MAX. FACTORED			
N - F				FORCE (LBS)			

DRY: SEASONED LUMBER.				CHORDS			
EXCEPT				MAX. FACTORED			
N - F				FORCE (LBS)			

DRY: SEASONED LUMBER.				CHORDS			
EXCEPT				MAX. FACTORED			
N - F				FORCE (LBS)			


DRY: SEASONED LUMBER.				CHORDS			
EXCEPT				MAX. FACTORED			
N - F				FORCE (LBS)			

DRY: SEASONED LUMBER.				CHORDS			
EXCEPT				MAX. FACTORED			
N - F				FORCE (LBS)			


DRY: SEASONED LUMBER.				CHORDS			
EXCEPT				MAX. FACTORED			
N - F				FORCE (LBS)			

DRY: SEASONED LUMBER.				CHORDS			
EXCEPT				MAX. FACTORED			
N - F				FORCE (LBS)			

DRY: SEASONED LUMBER.				CHORDS			
EXCEPT				MAX. FACTORED			
N - F				FORCE (LBS)			

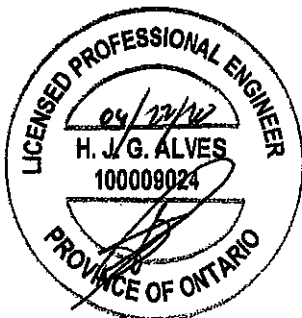


Structural component only
DWG# T-2007151

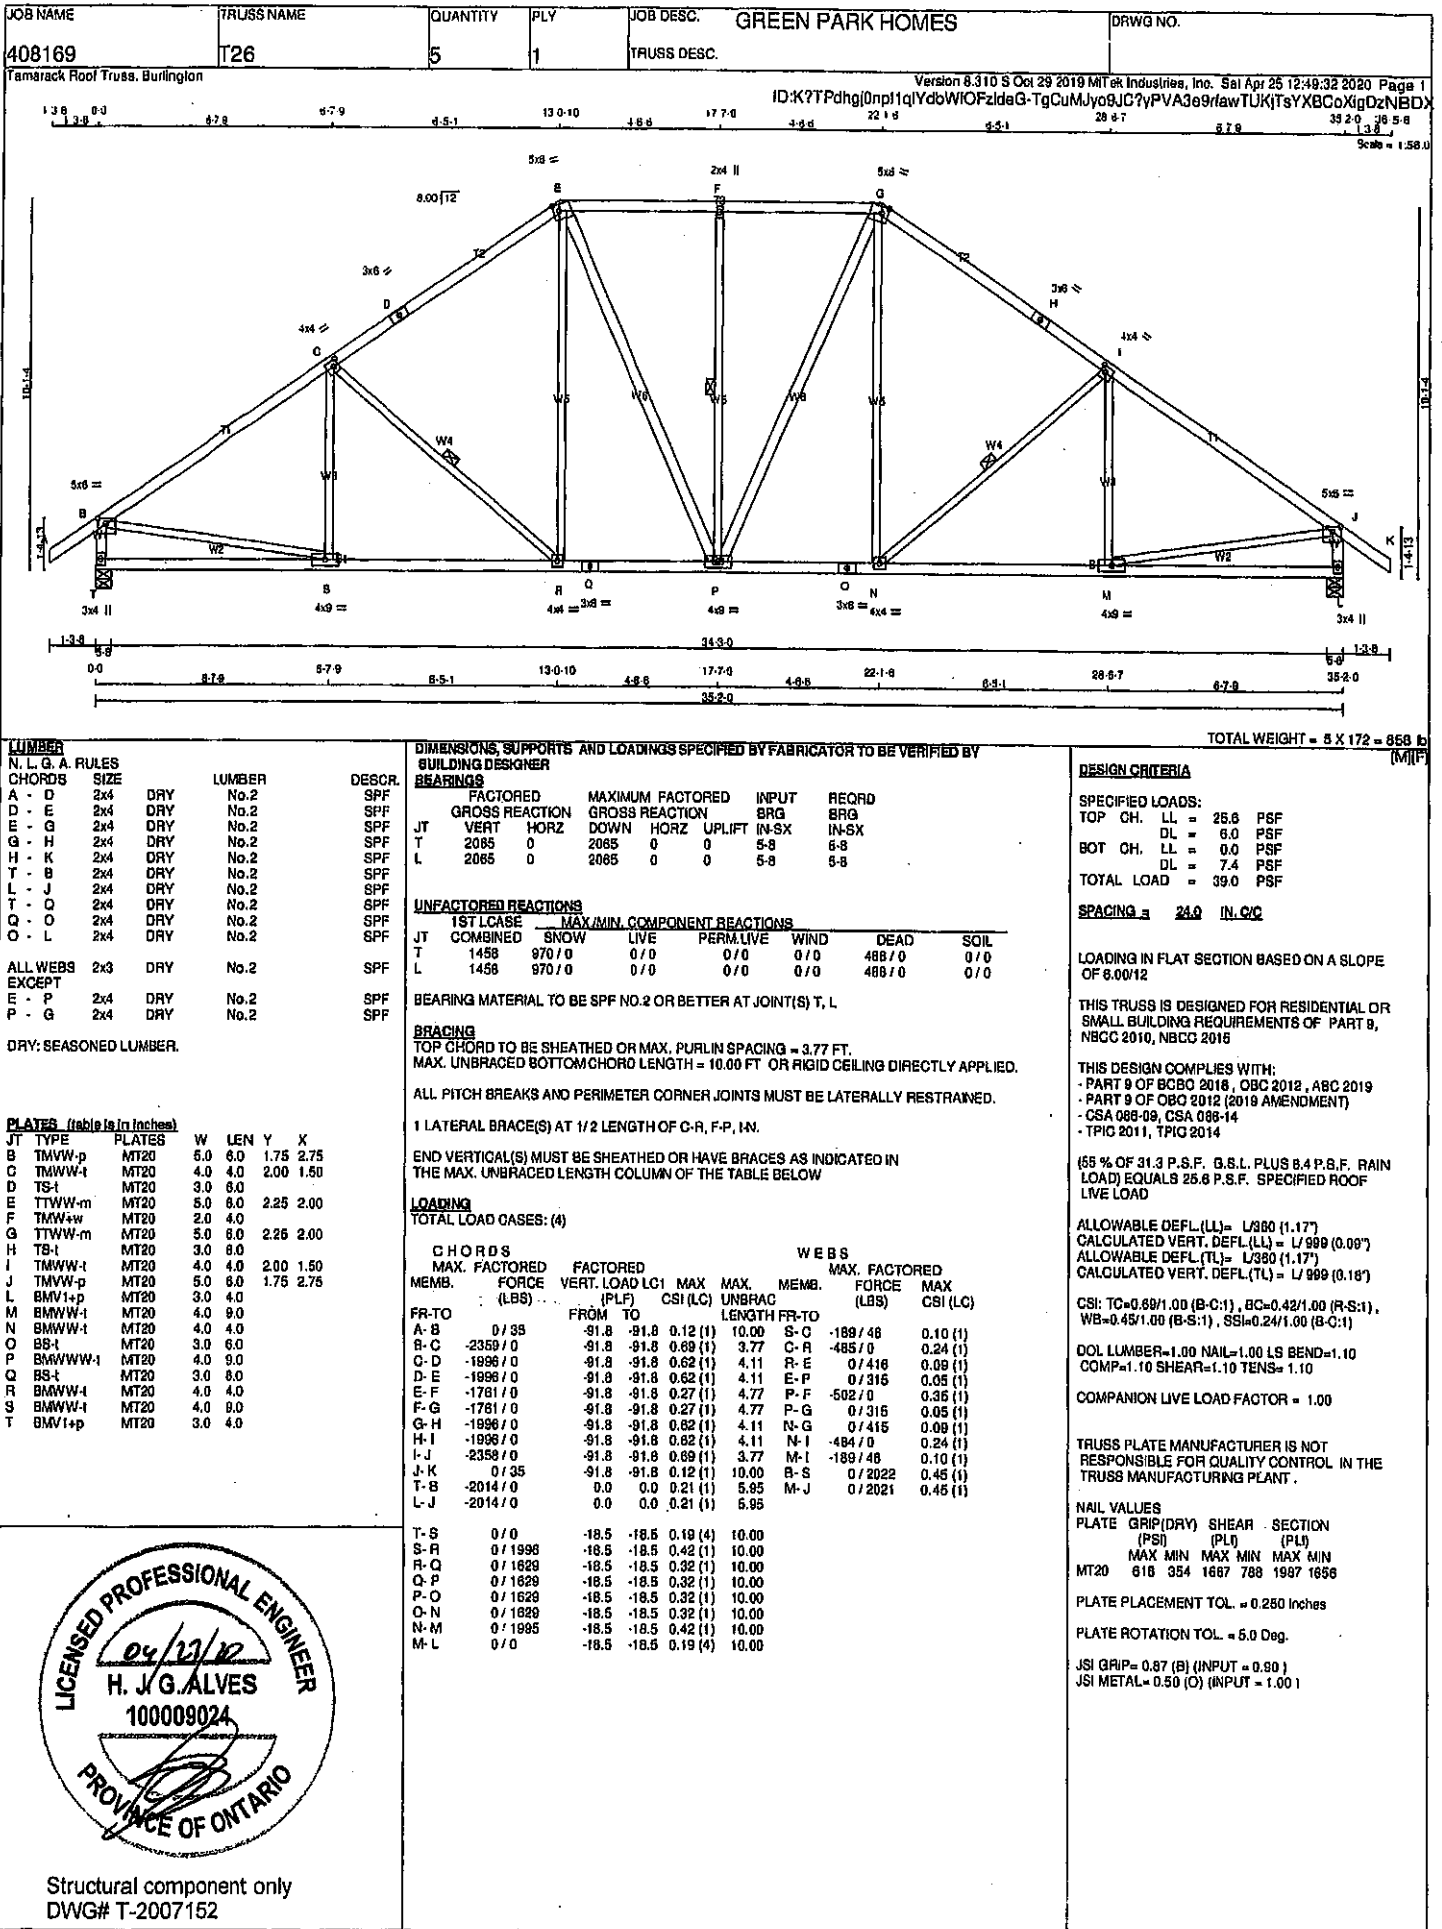

JOB NAME 408169	TRUSS NAME T27	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310 S.Oct 20 2019 Mtak Industries, Inc. Sat Apr 25 12:49:33 2020 Page 1
ID:K?TPdHg[0npl1qYdbWIOFzdeG-xrmGZfzRwdKZZ4MdMq4CoSb3k2Cb?nKQSHGCFzNBDW

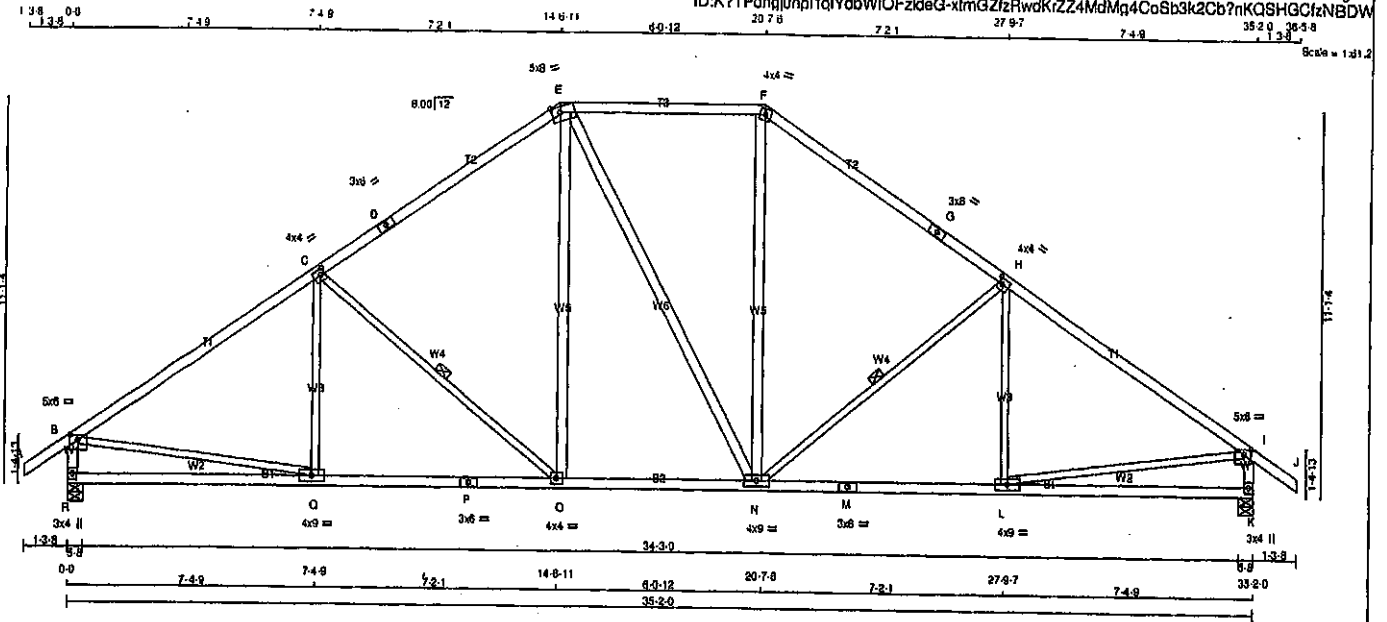

N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2	
D - E	2x4	DRY	No.2	
E - F	2x4	DRY	No.2	
F - G	2x4	DRY	No.2	
G - J	2x4	DRY	No.2	
J - B	2x4	DRY	No.2	
B - I	2x4	DRY	No.2	
I - P	2x4	DRY	No.2	
P - M	2x4	DRY	No.2	
M - K	2x4	DRY	No.2	
ALL WEBS	2x3	DRY	No.2	
EXCEPT				
O - E	2x4	DRY	No.2	
E - N	2x4	DRY	No.2	
N - F	2x4	DRY	No.2	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.75	2.75
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TS-t	MT20	3.0	6.0		
E	TTWV-m	MT20	5.0	8.0	2.00	3.00
F	TTW-m	MT20	4.0	4.0		
G	TS-t	MT20	3.0	6.0		
H	TMVW-t	MT20	4.0	4.0	2.00	1.50
I	TMVW-p	MT20	5.0	8.0	1.75	2.75
K	BMV1-p	MT20	3.0	4.0		
L	BMVW-t	MT20	4.0	8.0		
M	BS-t	MT20	3.0	6.0		
N	BMVWV-t	MT20	4.0	8.0		
O	BMVW-t	MT20	4.0	4.0		
P	BS-t	MT20	3.0	6.0		
Q	BMVW-t	MT20	4.0	8.0		
R	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	HORZ	DOWN	HORZ
R	2065	0	2065
K	2065	0	2065

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
R	1458	970 / 0	0 / 0	0 / 0	488 / 0
K	1458	970 / 0	0 / 0	0 / 0	488 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.45 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	FORCE	VERT. LOAD	FACTORED	MAX. FACTORED	WEBS	MEMB.	FORCE	MAX. FACTORED
		(LBS)	(PLF)	(LBS)	(LBS)			(LBS)	(LBS)
FR-TO						FR-TO			
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	C-Q	-139 / 76	0.09 (1)	
B-C	-2358 / 0	-91.8	-91.8	0.89 (1)	3.45	C-O	-605 / 0	0.38 (1)	
C-D	-1888 / 0	-91.8	-91.8	0.78 (1)	3.91	O-E	0 / 498	0.08 (1)	
D-E	-1888 / 0	-91.8	-91.8	0.78 (1)	3.91	E-N	0 / 500	0.08 (1)	
E-F	-1538 / 0	-91.8	-91.8	0.47 (1)	4.74	N-F	-804 / 0	0.38 (1)	
F-G	-1888 / 0	-91.8	-91.8	0.78 (1)	3.91	H-H	-140 / 75	0.09 (1)	
G-H	-1888 / 0	-91.8	-91.8	0.78 (1)	3.91	L-H	0 / 2020	0.45 (1)	
H-I	-2367 / 0	-91.8	-91.8	0.89 (1)	3.45	Q-Q	0 / 2019	0.45 (1)	
I-J	0 / 35	-91.8	-91.8	0.12 (1)	10.00	L-I			
R-B	-2009 / 0	0.0	0.0	0.21 (1)	5.95				
K-I	-2009 / 0	0.0	0.0	0.21 (1)	5.95				
R-Q	0 / 0	-18.5	-18.5	0.25 (4)	10.00				
Q-P	0 / 1999	-18.5	-18.5	0.45 (1)	10.00				
P-O	0 / 1999	-18.5	-18.5	0.45 (1)	10.00				
O-N	0 / 1538	-18.5	-18.5	0.33 (1)	10.00				
N-M	0 / 1999	-18.5	-18.5	0.45 (1)	10.00				
M-L	0 / 1999	-18.5	-18.5	0.45 (1)	10.00				
L-K	0 / 0	-18.5	-18.5	0.24 (4)	10.00				

TOTAL WEIGHT = 2 X 188 = 333 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CSI: TC=0.89/1.00 (B-C:1), BC=0.45/1.00 (O-Q:1), WB=0.45/1.00 (B-Q:1), SB=0.27/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1697 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.80 (F) (INPUT = 0.80)
JSI METAL= 0.88 (F) (INPUT = 1.00)




Structural component only
DWG# T-2007153

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T28	1	2	GREEN PARK HOMES	

Tamareck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:34 2020 Page 1
ID:K?TPdghj0np11qYdbWIOFzKdeG-P3J/n?_3gwSIBjYB3BJk?uz8RBKVIUI60pl5zNBDV

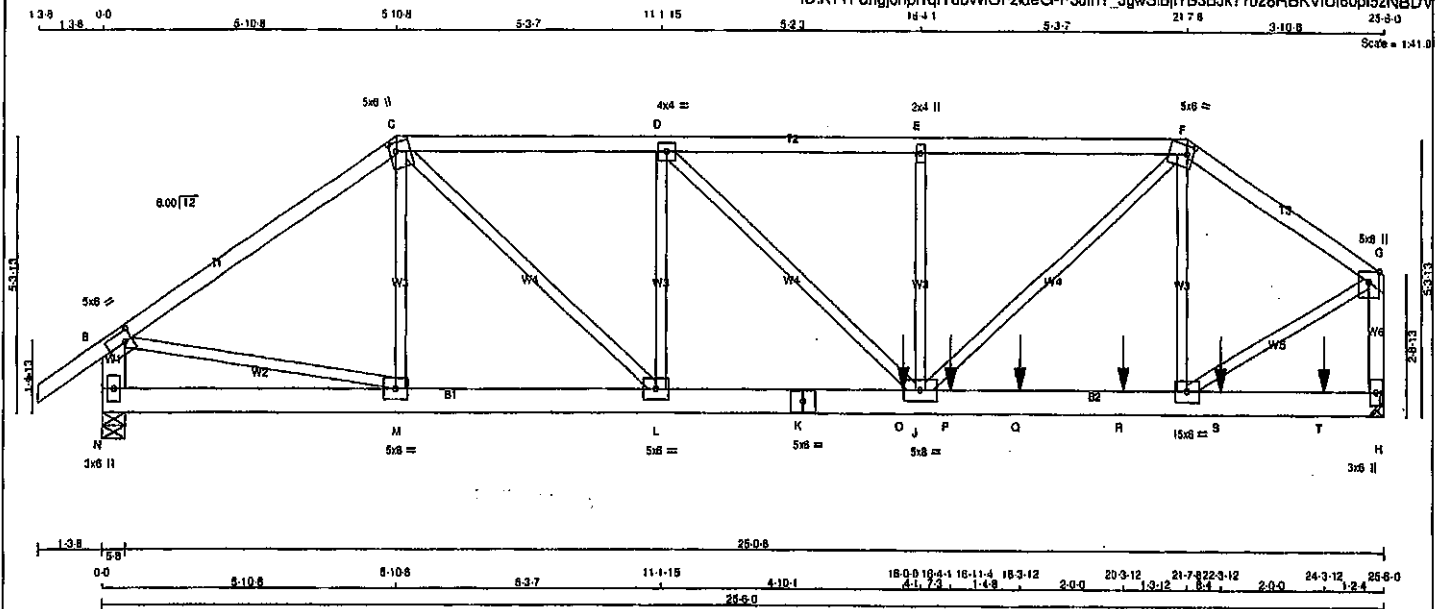

TOTAL WEIGHT = 2 X 122 = 245 lb

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES	A - C	2x4	DRY	No.2	SPF
	C - F	2x4	DRY	No.2	SPF
	F - G	2x4	DRY	No.2	SPF
	N - B	2x6	DRY	No.2	SPF
	H - G	2x4	DRY	No.2	SPF
	N - K	2x6	DRY	No.2	SPF
	K - H	2x6	DRY	No.2	SPF
	ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
C - F	12	TOP
F - G	12	TOP
H - G	12	TOP
N - B	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
N - K	12	TOP
K - H	12	SIDE (163.1)
WEBS : (0.122"x3") SPIRAL NAILS		
E - J	8	SIDE (77.0)
2x3	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BRACKING	FACTORED		MAXIMUM FACTORED		INPUT		REQD	
	GROSS REACTION	GROSS REACTION	DOWN	HORZ	BRG	BRG	IN-SX	IN-SX
JT	2086	0	2086	0	0	5.8	5.8	
N	2756	0	2756	0	0	MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
N	1470	994 / 0	0 / 0	0 / 0	0 / 0	478 / 0
H	1941	1320 / 0	0 / 0	0 / 0	0 / 0	620 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.78 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED	FACTORED	MAX. FACTORED	FACTORED
	FORCE (LBS)	VERT. LOAD (LBS)	FORCE (LBS)	FORCE (LBS)
		PLF		
		CS1 (LC)		
		MAX		
		UNBRACED LENGTH		
		FR-TO		
A-B	0 / 35	-91.8	-91.8	0.07 (1)
B-C	-2383 / 0	-91.8	-91.8	0.37 (1)
C-D	-3093 / 0	-91.8	-91.8	0.24 (1)
D-E	-3519 / 0	-91.8	-91.8	0.25 (1)
E-F	-3519 / 0	-91.8	-91.8	0.24 (1)
F-G	-2352 / 0	-91.8	-91.8	0.16 (1)
G-H	-2037 / 0	0.0	0.0	0.07 (1)
H-G	-2632 / 0	0.0	0.0	0.19 (1)
N-M	0 / 0	-18.5	-18.5	0.04 (1)
M-L	0 / 1959	-18.5	-18.5	0.14 (1)
L-K	0 / 3093	-18.5	-18.5	0.27 (1)
K-O	0 / 3093	-18.5	-18.5	0.27 (1)
O-J	0 / 3093	-18.5	-18.5	0.27 (1)
J-P	0 / 1942	-18.5	-18.5	0.23 (1)
P-Q	0 / 1942	-18.5	-18.5	0.23 (1)
Q-R	0 / 1942	-18.5	-18.5	0.23 (1)
R-I	0 / 1942	-18.5	-18.5	0.23 (1)
I-S	0 / 0	-18.5	-18.5	0.10 (1)
S-T	0 / 0	-18.5	-18.5	0.10 (1)
T-H	0 / 0	-18.5	-18.5	0.10 (1)

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
O	18-0-0	-997	-997	---	FRONT	VERT	TOTAL	---	C1
P	18-11-4	-187	-187	---	FRONT	VERT	TOTAL	---	C1
Q	18-3-12	-187	-187	---	FRONT	VERT	TOTAL	---	C1
R	20-3-12	-187	-187	---	FRONT	VERT	TOTAL	---	C1
S	22-3-12	-174	-174	---	FRONT	VERT	TOTAL	---	C1
T	24-3-12	-173	-173	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2016

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2016, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 089-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFLECTION (LL) = L/360 (0.85")
CALCULATED VERT. DEFLECTION (LL) = L/999 (0.08")
ALLOWABLE DEFLECTION (TL) = L/360 (0.85")
CALCULATED VERT. DEFLECTION (TL) = L/999 (0.11")

CS1: TC=0.37/1.00 (B-C:1), SC=0.27/1.00 (J-L:1),
WB=0.28/1.00 (G-H:1), SS=0.34/1.00 (J-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (F) (INPUT = 0.90)

JSI METAL = 0.45 (G) (INPUT = 1.00)

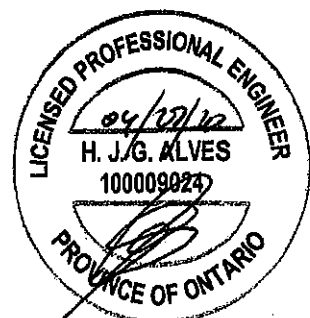

Structural component only
DWG# T-2007154 1/2

CONTINUED ON PAGE 2


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T28	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 8 Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 12:49:34 2020 Page 2
ID:K?TPdhi0npl1qYdbWlQFzIdeG-P3Jln?_3qwSiBjYB3Bjk??uz8R8KVIUI80p5zN8DV

PLATES (tablets in inches)


JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-l	MT20	5.0	6.0	2.50	1.75
C	TTWW+m	MT20	5.0	6.0	2.00	1.50
D	TMVW-l	MT20	4.0	4.0		
E	TMVW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.00	1.50
G	TMVW+p	MT20	5.0	6.0	Edge	
H	BMV1+p	MT20	3.0	6.0		
I, L, M						
I	BMVW-l	MT20	5.0	6.0		
J	BMVW-l	MT20	5.0	6.0		
K	BS-l	MT20	5.0	6.0		
N	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

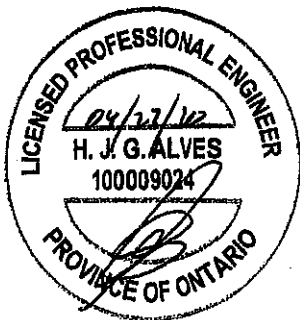

Structural component only
DWG# T-2007154

JOB NAME 408169	TRUSS NAME T30	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

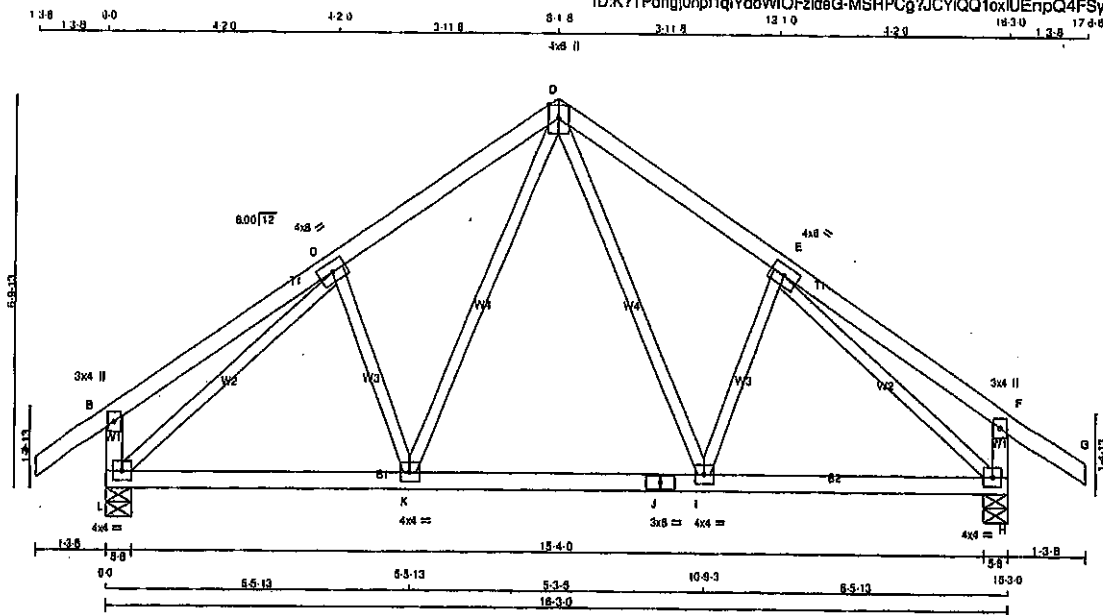

TOTAL WEIGHT = 2 X 72 = 145 lb
(M/F)

LUMBER				N. L. G. A. RULES	
CHORDS	SIZE	DRY	LUMBER	DESCR.	SPF
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
L - B	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
DRY, SEASONED LUMBER.					

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV-p	MT20	3.0	4.0	
C	TMWW-1	MT20	4.0	8.0	
D	TTWW-p	MT20	4.0	8.0	Edge
E	TMVW-1	MT20	4.0	8.0	
F	TMV-p	MT20	3.0	4.0	
H	BMVW-1	MT20	4.0	4.0	
I	BMVW-1	MT20	4.0	4.0	
J	BS-1	MT20	3.0	8.0	
K	BMVW-1	MT20	4.0	4.0	
L	BMVW-1	MT20	4.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
L	1022	0	1022	0	0	5-8	5-8	5-8	5-8
H	1022	0	1022	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST CASE		MAX./MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
L	720	488 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0	
H	720	488 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (PL) OSI (LC)	MEMB.	FORCE (LBS)	MAX. (PL) OSI (LC)	
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	D-1	0 / 336	0.08 (1)	
B-C	0 / 24	-91.8	-91.8 0.24 (1)	E-2	-217 / 0	0.08 (1)	
C-D	-845 / 0	-91.8	-91.8 0.19 (1)	K-D	0 / 336	0.08 (1)	
D-E	-845 / 0	-91.8	-91.8 0.19 (1)	C-K	-217 / 0	0.08 (1)	
E-F	0 / 24	-91.8	-91.8 0.24 (1)	L-C	-1042 / 0	0.52 (1)	
F-G	0 / 35	-91.8	-91.8 0.12 (1)	E-H	-1042 / 0	0.52 (1)	
L-B	-268 / 0	0.0	0.0 0.03 (1)				
H-F	-268 / 0	0.0	0.0 0.03 (1)				
L-K	0 / 762	-18.5	-18.5 0.19 (1)				
K-J	0 / 557	-18.5	-18.5 0.17 (4)				
J-I	0 / 557	-18.5	-18.5 0.17 (4)				
I-H	0 / 762	-18.5	-18.5 0.19 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/G

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2010
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPO 2011, TPO 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/899 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/899 (0.04")

GS: TC=0.24/1.0 (B-C:1), BC=0.18/1.0 (H-I:1), WS=0.52/1.0 (G-L:1), SS=0.15/1.0 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.88 (H) (INPUT = 0.90)
JSI METAL= 0.29 (L) (INPUT = 1.00)



Structural component only
DWG# T-2007156

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T30S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 6.310 5 Oct 20 2019 MTEK Industries, Inc. Sat Apr 26 12:49:38 2020 Page 1
ID:K7TPdhq|Onp|tq|Ydb|WIOFz|deG-lqZ9cM1Zk8y8gKyJQvGFvAbElmYGAW4ak_1usznBDR

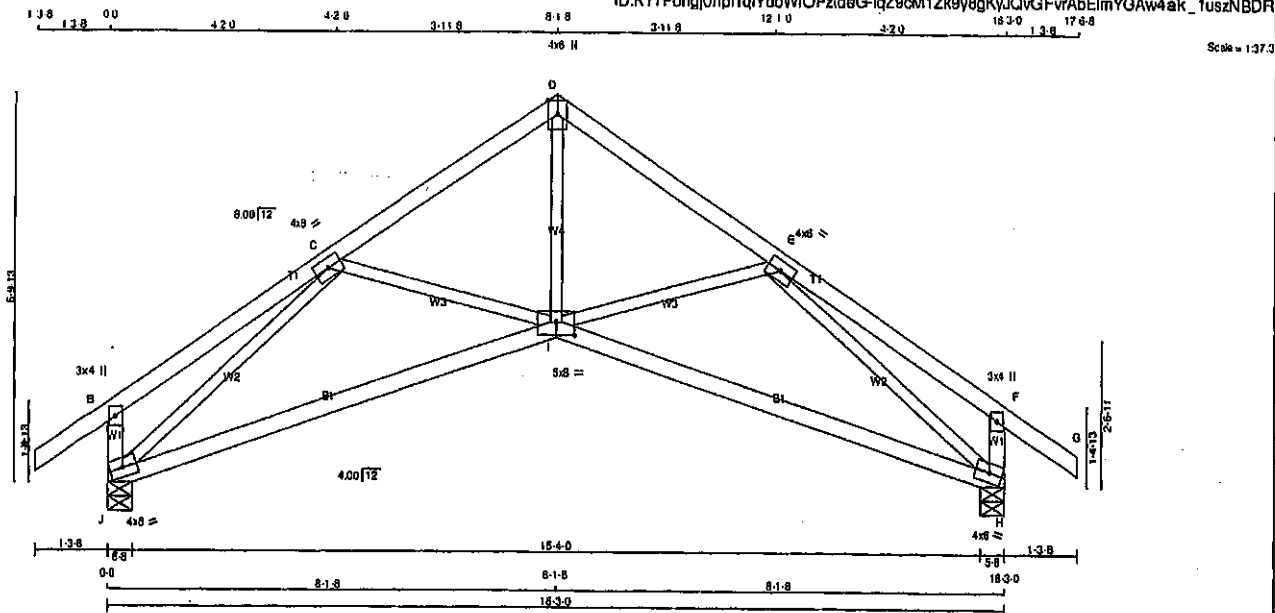

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
J - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	8.0		
D	TTW+p	MT20	4.0	8.0	Edge	
E	TMWW-t	MT20	4.0	8.0		
F	TMV+p	MT20	3.0	4.0		
H	BMVW1-t	MT20	4.0	8.0		
I	BMVW1-p	MT20	5.0	8.0	2.75	4.00
J	BMVW1-t	MT20	4.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
J	1022	0	0	5-8	5-8
H	1022	0	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	720	488 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0	0 / 0
H	720	488 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.76 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC) UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)	
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	I-D	0 / 842	0.21 (1)	
B-C	0 / 22	-91.8	-91.8 0.22 (1)	I-E	-143 / 11	0.05 (1)	
C-D	-1134 / 0	-91.8	-91.8 0.19 (1)	C-I	-143 / 11	0.05 (1)	
D-E	-1134 / 0	-91.8	-91.8 0.19 (1)	J-C	-1478 / 0	0.78 (1)	
E-F	0 / 22	-91.8	-91.8 0.22 (1)	E-H	-1478 / 0	0.78 (1)	
F-G	0 / 35	-91.8	-91.8 0.12 (1)				
J-B	-273 / 0	0.0	0.0 0.03 (1)				
H-F	-273 / 0	0.0	0.0 0.03 (1)				
J-I	0 / 1120	-18.5	-18.5 0.44 (4)				
I-H	0 / 1120	-18.5	-18.5 0.44 (4)				

TOTAL WEIGHT = 2 X 67 = 133 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.84")
CALCULATED VERT. DEFL.(LL) = L/899 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.84")
CALCULATED VERT. DEFL.(TL) = L/789 (0.25")

CSI: TO=0.22/1.00 (E-F:1), BC=0.44/1.00 (H-I:4), WB=0.78/1.00 (C-J:1), SS=0.15/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1686

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (H) (INPUT = 0.80)
JSI METAL = 0.35 (H) (INPUT = 1.00)



Structural component only
DWG# T-2007158

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T31S	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRAUSS DESC.	

Version 8.310 5 Oct 28 2019 MITek Industries, Inc. Sat Apr 25 12:49:39 2020 Page 1

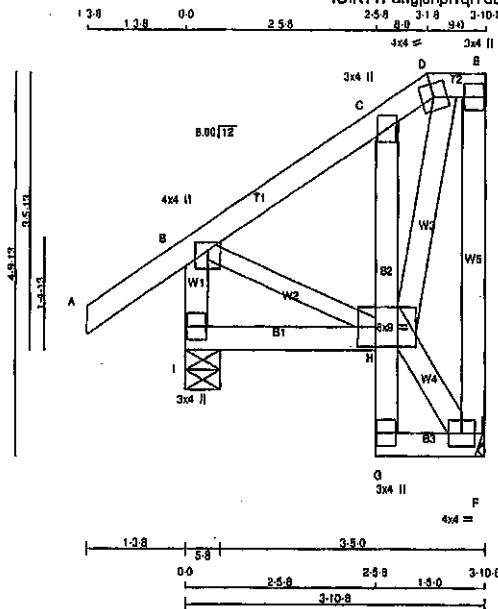

Scale = 1/2" = 1'-0"

TOTAL WEIGHT = 29 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
I - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
G - C	2x4	DRY	No.2
G - F	2x4	DRY	No.2
ALL WEBS	2x4	DRY	No.2
EXCEPT			
B - H	2x3	DRY	No.2

SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
		FACTORED		MAXIMUM FACTORED		INPUT REQD	
		GROSS REACTION		GROSS REACTION		BRG BRG	
JT		VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX
F		193	0	193	0	0	MECHANICAL
I		381	0	381	0	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

1ST LOASE	MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	139	88 / 0	0 / 0	0 / 0	0 / 0	49 / 0	0 / 0
I	262	181 / 0	0 / 0	0 / 0	0 / 0	72 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 MAX CSI (LC)	
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.14 (5)	10.00	H-F	-27 / 0	0.00 (1)
B-C	-87 / 0	-91.8	-91.8 0.09 (1)	8.25	G-H	0 / 88	0.02 (1)
C-D	-99 / 0	-91.8	-91.8 0.07 (1)	8.25	H-D	0 / 173	0.03 (1)
D-E	-11 / 0	-91.8	-91.8 0.07 (1)	8.25			
E-F	-148 / 0	0.0	0.0 0.04 (1)	7.81			
F-B	-327 / 0	0.0	0.0 0.02 (4)	7.81			
I-H	0 / 8	-18.5	-18.5 0.03 (4)	10.00			
G-H	-2 / 8	0.0	0.0 0.05 (1)	10.00			
H-C	-203 / 0	0.0	0.0 0.04 (1)	7.81			
G-F	0 / 30	-18.5	-18.5 0.03 (1)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TO=0.14/1.00 (A-B-S), BC=0.05/1.00 (G-H-I), WB=0.03/1.00 (D-H-I), SI=0.12/1.00 (D-E-I)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PS)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.23 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)

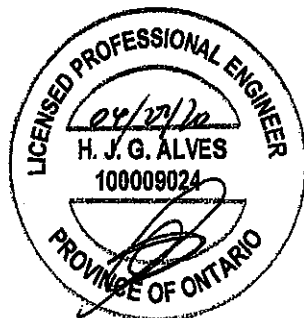

Structural component only
DWG# T-2007159

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:49:40 2020 Page 1
ID:K7TPdhgJ0npl1qYabWIOFzdeG-EDhw122qGmCsve8IKlI_GFY1ZYDkG4M22T7ylzNBDF

Scale = 1/20'

The structural drawing shows a roof truss system with various members labeled A through I. Dimensions are provided in feet and inches. Key features include a central vertical support, diagonal bracing members (W1-W6), and horizontal chord members (B1-B3). Connections are detailed at joints F, G, H, and I.

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
I - B	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
G - D	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (tables in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TTWW+m	MT20	5.0	8.0	Edge	
D	TMV+p	MT20	3.0	4.0		
E	TMVW-l	MT20	4.0	4.0		
F	BMVW1-t	MT20	4.0	4.0		
G	BMV+p	MT20	3.0	4.0		
H	BMVWWW-l	MT20	5.0	8.0	3.00	2.50
I	BMVW1-t	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	REQRD BRG IN-SX
JT VERT	DOWN	UP	DOWN
F 191 0	191 0	MECHANICAL	5-8
I 362 0	362 0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1'-6".

UNFACTORED REACTIONS

1ST LC CASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
F 136	87 / -12 0 / 0 0 / 0 0 / 0 49 / 0 0 / 0
I 253	182 / 0 0 / 0 0 / 0 0 / 0 71 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)!

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO						FR-TO			
A-B	0 / 35	-91.8	-91.8	0.14 (5)	10.00	C-H	0 / 60	0.01 (1)	
B-C	-41 / 0	-91.8	-91.8	0.13 (5)	6.25	H-F	-7 / 0	0.00 (1)	
C-D	-89 / 0	-91.8	-91.8	0.02 (1)	8.25	H-E	0 / 153	0.03 (1)	
D-E	-68 / 0	-91.8	-91.8	0.02 (1)	6.25	I-C	-100 / 34	0.02 (1)	
F-E	-175 / 0	0.0	0.0	0.03 (1)	7.81				
I-B	-253 / 0	0.0	0.0	0.03 (1)	7.81				
I-H	-18 / 53	-18.5	-18.5	0.04 (4)	6.25				
G-H	0 / 13	0.0	0.0	0.01 (1)	10.00				
H-D	-142 / 0	0.0	0.0	0.01 (1)	7.81				
G-F	0 / 5	-18.5	-18.5	0.01 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(85% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/889 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/889 (0.00")

CSI: TC=0.14/1.00 (A-B-5), BC=0.04/1.00 (H-I-4), WB=0.03/1.00 (E-H-1), SS=0.09/1.00 (A-B-5).

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PLI)	SECTION (PLI)
(PS)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20 618 354	1667 788	1667 1658

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.18 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)


PROFESSIONAL ENGINEER
H. J.G. ALVES
100009024
PROVINCE OF ONTARIO

Structural component only
DWG# T-2007160

JOB NAME 408169	TRUSS NAME T33	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 9 Oct 29 2019 MITek Industries, Inc. Sat Apr 26 12:49:41 2020 Page 1
ID:K?TPdhgJ0npl1qIYdbWIOFzIdeG-iPFIF03S14LjXohu51pyWUo8MznVTtTWGIDhUBzNBDC

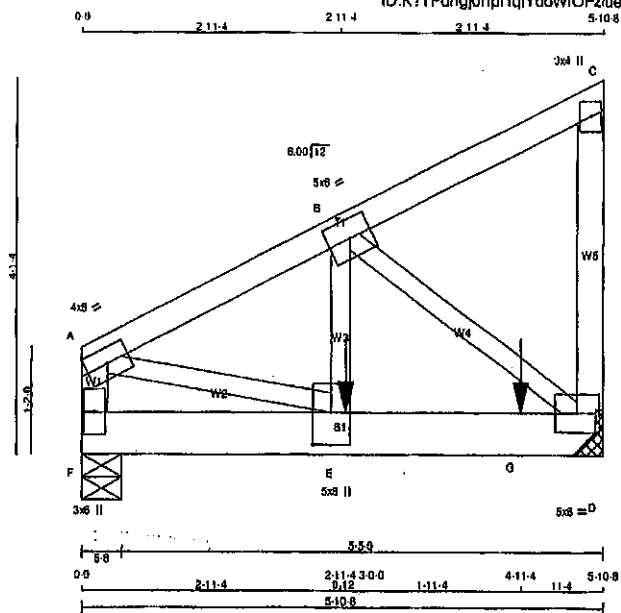

Scale = 1/23.2

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR.
F - A	2x4	DRY	No.2		SPF
A - C	2x4	DRY	No.2		SPF
D - C	2x4	DRY	No.2		SPF
F - D	2x8	DRY	No.2		SPF
ALL WEBS		2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.					

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F-A 1	12	TOP
A-C 1	12	TOP
C-D 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F-D 2	9	SIDE(305.2)
WEBS : (0.122"x3") SPIRAL NAILS		
B-E 1	2	SIDE(408.9)
2x3	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	4.0	8.0	Edge
B	TMVW-t	MT20	5.0	8.0	
C	TMVW-p	MT20	3.0	4.0	
D	BMVW-t	MT20	5.0	8.0	
E	BMVW-t	MT20	5.0	8.0	4.26 2.50

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT VERT	DOWN	UP	IN-SX
F 1914	0	1914	0
D 2859	0	2859	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

1ST CASE	MAX/MIN COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
F 1348	915 / 0 0 / 0 0 / 0 0 / 0 434 / 0 0 / 0
D 2015	1359 / 0 0 / 0 0 / 0 0 / 0 687 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.59 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO		FR-TO			
F-A	-1877 / 0	0.0 0.0 0.10 (1)	7.81	A-E	0 / 2380	0.29 (1)	
A-B	-2568 / 0	-91.8 -91.8 0.08 (1)	5.59	E-B	0 / 2808	0.32 (1)	
B-C	-7 / 0	-91.8 -91.8 0.08 (1)	10.00	B-D	-2898 / 0	0.35 (1)	
D-C	-120 / 0	0.0 0.0 0.01 (1)	7.81				
F-E	0 / 0	-18.5 -18.5 0.01 (1)	10.00				
E-G	0 / 2301	-18.5 -18.5 0.49 (1)	10.00				
G-D	0 / 2301	-18.5 -18.5 0.49 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	3-0-0	-2737	-2737	---	BACK	VERT	TOTAL	---	C1
G	4-11-4	-1388	-1388	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/ 899 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.03")

CSI: TC=0.10/1.00 (A-F:1), BC=0.49/1.00 (D-E:1), WB=0.38/1.00 (B-D:1), BS=0.33/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1687 768 1887 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.84 (B) (INPUT = 0.90)
JSI METAL = 0.44 (E) (INPUT = 1.00)

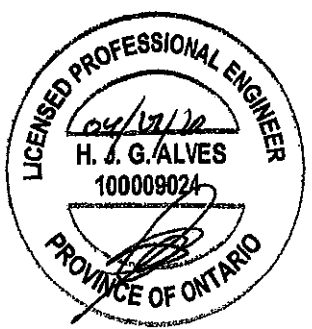

Structural component only
DWG# T-2007161 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T33	1	2	GREEN PARK HOMES TRUSS DESC.	


Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Sat Apr 26 12:49:41 2020 Page 2
ID:K?TPdhaQnpl1qtYdbWlOFzldaG-iPFIFQ3S14LIXchu51pyWUo8MznVTgTWQIDhUBzN8DC

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
F 8MV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

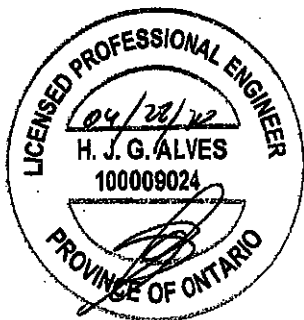

Structural component only
DWG# T-2007161 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T40	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 13:02:15 2020 Page 2
ID:K?TPdhoi0npt1qlYdbWIOFzideG-dToLVCBPTkKk_gKoGOLn4U0ubv6N8cVI7eavUzNB1c

PLATES (Table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	5.0	8.0		
C	TTWW+m	MT20	5.0	8.0	2.00	2.25
D	TMVW-1	MT20	5.0	8.0		
E	TMVW+w	MT20	3.0	8.0		
F	TS-1	MT20	5.0	8.0		
G	TMVW-1	MT20	5.0	8.0		
H	TTWW+m	MT20	5.0	8.0	2.00	2.25
I	TMVW-1	MT20	5.0	8.0		
K	BMV1+p	MT20	3.0	8.0		
L	BMVW-1	MT20	5.0	8.0	2.50	2.50
M	BMVW-1	MT20	5.0	8.0		
N	BS-1	MT20	5.0	8.0		
O	BMVW-1	MT20	5.0	8.0		
P	BS-1	MT20	5.0	8.0		
Q	BMVW-1	MT20	5.0	8.0		
R	BMVW-1	MT20	5.0	8.0	2.50	2.50
S	BMV1+p	MT20	3.0	8.0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-437	-437	---	FRONT	VERT	TOTAL	---	C1
E	17-7-0	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	29-3-8	-437	-437	---	FRONT	VERT	TOTAL	---	C1
L	29-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
N	21-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
O	17-7-0	-28	-28	---	FRONT	VERT	TOTAL	---	C1
P	13-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	19-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	1-11-4	-25	-25	---	FRONT	VERT	TOTAL	---	C1
AE	3-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AF	7-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AG	9-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AH	11-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AI	15-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AJ	19-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AK	23-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AL	25-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AM	27-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AN	31-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AO	33-2-12	-25	-25	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007168

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T40Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 13:02:17 2020 Page 1			

ID:K?TPdhq|0npl1q|YdbWIOFzIdeG-arw5vuDf_MaSDzUBNpNF9v6Bulk?cSGo6JLh0NzNB1a

1.38 0.0 1.38 3.108 5.108 2.114 2.00 1.102 1.194 5.9-10 17.70 5.9-10 33.4-10 5.10-14 29.3-8 35.20 35.20 1.38

Scale = 1:57.3

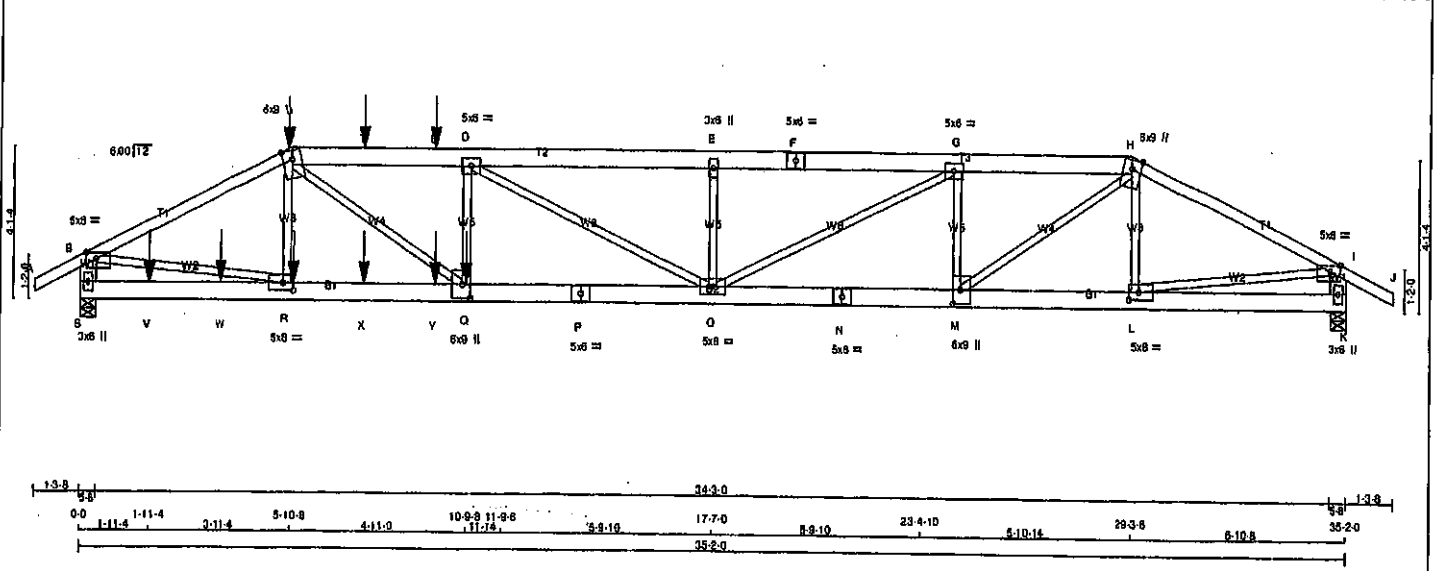

TOTAL WEIGHT = 2 X 169 = 338 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER			
N. L. G. A. RULES				BEARINGS			
CHORDS	SIZE	DRY	LUMBER	FACTORED	MAXIMUM FACTORED	INPUT	REQD
A - C	2x4	DRY	No.2	SPF	GROSS REACTION	BRG	BRG
C - F	2x6	DRY	No.2	SPF	VERT	HORZ	UPLIFT
F - H	2x6	DRY	No.2	SPF	DOWN	HORZ	UPLIFT
H - J	2x4	DRY	No.2	SPF	4582	0	5-8
S - B	2x6	DRY	No.2	SPF	3047	0	5-8
K - I	2x6	DRY	No.2	SPF			
S - P	2x6	DRY	No.2	SPF			
P - N	2x6	DRY	No.2	SPF			
N - K	2x6	DRY	No.2	SPF			
ALL WEBS	2x3	DRY	No.2	SPF			
EXCEPT							

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	12	SIDE(81.0)
H-J	12	TOP
C-F	12	SIDE(81.0)
F-H	12	TOP
S-B	12	TOP
K-I	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S-P	12	SIDE(163.1)
P-N	12	TOP
N-K	12	TOP

WEBS : (0.122"x3") SPIRAL NAILS	LOAD(PLF)
2x3	
D-Q	1
G-M	3

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.15 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO						FR-TO			
A-B	0/28	-91.8	-91.8	0.07 (1)	10.00	R-C	-873/0	0.08 (1)	
B-C	-7293/0	-91.8	-91.8	0.72 (1)	3.15	C-Q	0/4988	0.62 (1)	
C-T	-10549/0	-91.8	-91.8	0.34 (1)	3.65	Q-D	-184/38	0.02 (1)	
T-U	-10549/0	-91.8	-91.8	0.34 (1)	3.55	D-O	-1207/0	0.72 (1)	
U-D	-10549/0	-91.8	-91.8	0.31 (1)	3.78	O-E	-848/0	0.08 (1)	
D-E	-9485/0	-91.8	-91.8	0.29 (1)	3.81	M-G	-1894/0	0.24 (1)	
E-F	-9485/0	-91.8	-91.8	0.29 (1)	3.81	M-H	0/3512	0.43 (1)	
F-G	-9485/0	-91.8	-91.8	0.17 (1)	4.44	L-H	-464/0	0.08 (1)	
G-H	-8958/0	-91.8	-91.8	0.48 (1)	4.08	B-R	0/6596	0.82 (1)	
H-I	-4808/0	-91.8	-91.8	0.07 (1)	10.00	L-I	0/4187	0.52 (1)	
I-J	0/28	-91.8	-91.8	0.07 (1)	10.00				
S-B	-4503/0	0.0	0.0	0.18 (1)	6.78				
K-I	-2890/0	0.0	0.0	0.11 (1)	7.91				


CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO						FR-TO			
S-V	0/0	-18.5	-18.5	0.08 (4)	10.00				
V-W	0/0	-18.5	-18.5	0.08 (4)	10.00				
W-R	0/0	-18.5	-18.5	0.08 (4)	10.00				
R-X	0/8557	-18.5	-18.5	0.50 (1)	10.00				
X-Y	0/8557	-18.5	-18.5	0.50 (1)	10.00				
Y-Q	0/8557	-18.5	-18.5	0.50 (1)	10.00				
Q-P	0/10548	-18.5	-18.5	0.77 (1)	10.00				
P-O	0/10548	-18.5	-18.5	0.77 (1)	10.00				
O-N	0/8955	-18.5	-18.5	0.50 (1)	10.00				
N-M	0/8955	-18.5	-18.5	0.50 (1)	10.00				
M-L	0/4144	-18.5	-18.5	0.28 (1)	10.00				
L-K	0/0	-18.5	-18.5	0.04 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LOC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-437	-437		BACK	VERT	TOTAL		C1
Q	10-9-8	-2715	-2715		BACK	VERT	TOTAL		C1
R	5-11-4	-28	-28		BACK	VERT	TOTAL		C1
T	7-11-4	-110	-110		BACK	VERT	TOTAL		C1
U	9-11-4	-110	-110		BACK	VERT	TOTAL		C1
V	1-11-4	-25	-25		BACK	VERT	TOTAL		C1
W	3-11-4	-28	-28		BACK	VERT	TOTAL		C1
X	7-11-4	-28	-28		BACK	VERT	TOTAL		C1
Y	9-11-4	-28	-28		BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

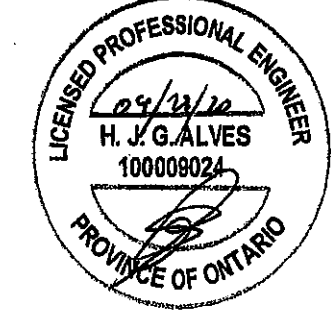

Structural component only
DWG# T-2007169

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019

- PART 8 OF CBC 2012 (2019 AMENDMENT)

- CSA 086-08, CSA 086-14

- TPIC 2011, TPIC 2014

(85% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')

CALCULATED VERT. DEFL.(LL) = L/989 (0.28')

ALLOWABLE DEFL.(TL) = L/360 (1.17')

CALCULATED VERT. DEFL.(TL) = L/881 (0.48')

CSI: TC=0.72/1.00 (B-C:1), BC=0.77/1.00 (C-Q:1),

WB=0.82/1.00 (B-R:1), BS=0.13/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(ORY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1887 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.80 (B) (INPUT = 0.90)

JSI METAL= 0.99 (P) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T40Z	1	2	GREEN PARK HOMES	
Tantareck Roof Truss, Burlington		TRUSS DESC.			

Version 8.316 5 Oct 20 2019 MiTek Industries, Inc. Sat Apr 25 13:02:17 2020 Page 2
ID:K?TPohg0npl1glYdbWIOFzideG-aw5vuDf MaSDzUBNoNF9v8Buik?cSGo8JLh0NzNB1a

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	2.00	3.50
C	TTWW+m	MT20	6.0	9.0	Edge	
D	TMWW-l	MT20	5.0	8.0		
E	TMW+w	MT20	3.0	6.0		
F	TS-l	MT20	5.0	6.0		
G	TMWW-l	MT20	5.0	6.0		
H	TTWW+m	MT20	8.0	9.0	Edge	
I	TMVW-p	MT20	5.0	8.0	2.00	3.50
K	BMV1+p	MT20	3.0	6.0		
L	BMWW-l	MT20	5.0	8.0	2.50	3.25
M	BMWW-l	MT20	6.0	9.0	4.50	2.50
N	BS-l	MT20	5.0	8.0		
O	BMWW-l	MT20	5.0	8.0		
P	BS-l	MT20	5.0	6.0		
Q	BMWW-l	MT20	6.0	9.0	4.50	2.50
R	BMWW-l	MT20	5.0	8.0	2.50	3.25
S	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007169 *yz*

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T41	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mike Industries, Inc. Sat Apr 25 13:02:18 2020 Page 1
ID:K?TPdngJ0npl1qYdbWfOfzIdeG-22UT7EDHfUj73OxWvUj8eJ865BLvLxLz4FZp2NB1Z

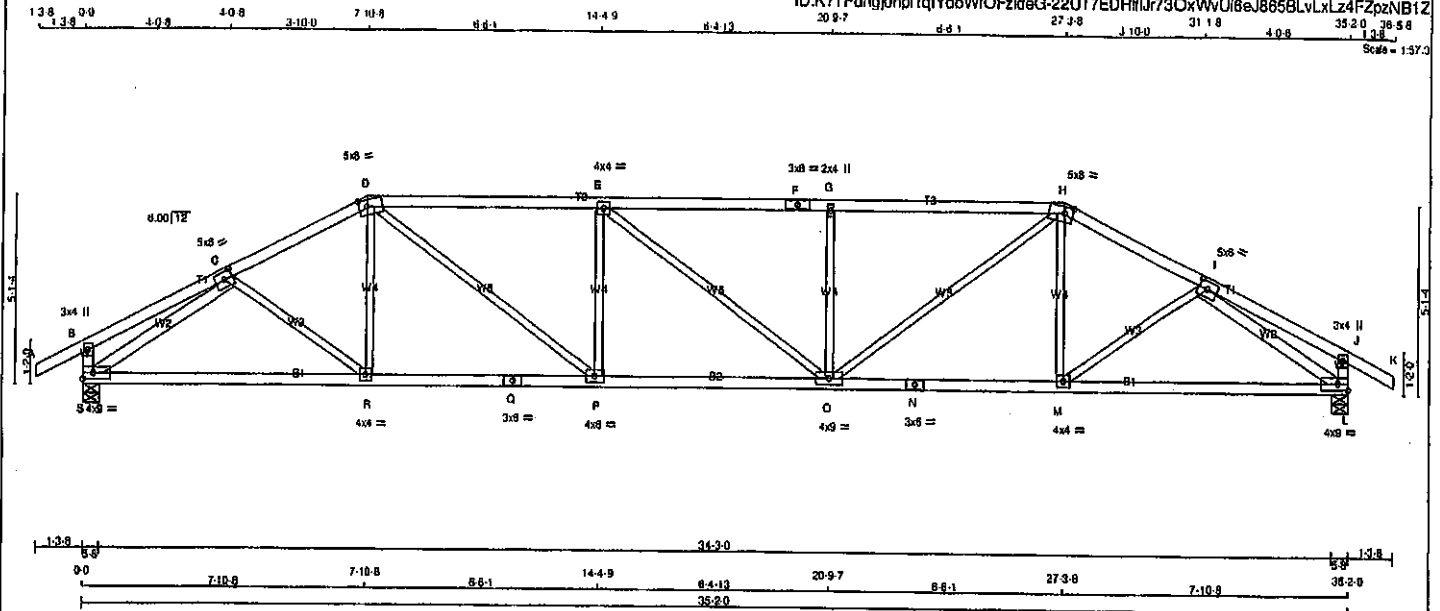

TOTAL WEIGHT = 2 X 139 = 278 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY			
N. L. G. A. RULES				BUILDING DESIGNER			
CHORDS	SIZE	LUMBER	DESCR.	BEARINGS			
A - D	2x4	DRY	No.2	FACTORED			
D - F	2x4	DRY	No.2	GROSS REACTION			
F - H	2x4	DRY	No.2	MAXIMUM FACTORED			
H - J	2x4	DRY	No.2	INPUT			
J - L	2x4	DRY	No.2	REQD			
L - N	2x4	DRY	No.2				
N - L	2x4	DRY	No.2				
ALL WEBS	2x3	DRY	No.2				
EXCEPT							
S - C	2x4	DRY	No.2				
I - L	2x4	DRY	No.2				
DRY: SEASONED LUMBER.							

PLATES (table in inches)	W	LEN	Y	X
JT TYPE				
B TMV+p	MT20	3.0	4.0	
C TMWW-i	MT20	5.0	6.0	2.50 2.75
D TMWW-m	MT20	5.0	6.0	2.25 2.75
E TMWW-i	MT20	4.0	4.0	
F TS-i	MT20	3.0	6.0	
G TMW-w	MT20	2.0	4.0	
H TTWW-m	MT20	6.0	6.0	2.25 2.75
I TMWW-i	MT20	5.0	6.0	2.50 2.75
J TMV+p	MT20	3.0	4.0	
L BMWW-i	MT20	4.0	9.0	Edge
M BMWW-i	MT20	4.0	4.0	
N BS-i	MT20	3.0	6.0	
O BMWW-i	MT20	4.0	9.0	
P BMWW-i	MT20	4.0	6.0	
Q BS-i	MT20	3.0	6.0	
R BMWW-i	MT20	4.0	4.0	
S BMWW-i	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

UNFACTORED REACTIONS							
1ST LOSE MAX/MIN COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1457	889 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1457	889 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.94 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FORCE	VERT. LOAD	MEMB.	MAX. FACTORED	FORCE	MAX
	(LBS)		CS1 (LC)		(LBS)		CS1 (LC)
FR-TO				FR-TO			
A-B	0 / 23	-91.8	-91.8 0.12 (1)	10.00	C-R	0 / 93	0.03 (4)
B-C	0 / 16	-91.8	-91.8 0.20 (1)	10.00	R-D	0 / 121	0.04 (4)
C-D	-2789 / 0	-91.8	-91.8 0.32 (1)	3.88	D-P	0 / 1267	0.29 (1)
D-E	-3508 / 0	-91.8	-91.8 0.85 (1)	2.94	P-E	-843 / 0	0.25 (1)
E-F	-3507 / 0	-91.8	-91.8 0.93 (1)	2.94	E-O	-2 / 0	0.00 (1)
F-G	-3507 / 0	-91.8	-91.8 0.93 (1)	2.94	O-G	-843 / 0	0.25 (1)
G-H	-3507 / 0	-91.8	-91.8 0.94 (1)	2.95	O-H	0 / 1268	0.28 (1)
H-I	-2789 / 0	-91.8	-91.8 0.32 (1)	3.88	M-H	0 / 121	0.04 (4)
I-J	0 / 16	-91.8	-91.8 0.20 (1)	10.00	M-I	0 / 93	0.03 (4)
J-K	0 / 23	-91.8	-91.8 0.12 (1)	10.00	S-C	-2974 / 0	0.83 (1)
S-B	-270 / 0	0.0	0.0 0.03 (1)	7.61	I-L	-2974 / 0	0.83 (1)
L-J	-270 / 0	0.0	0.0 0.03 (1)	7.61			
S-R	0 / 2417	-18.5	-18.5 0.53 (1)	10.00			
R-Q	0 / 2489	-18.5	-18.5 0.54 (1)	10.00			
Q-P	0 / 2489	-18.5	-18.5 0.54 (1)	10.00			
P-O	0 / 3509	-18.5	-18.5 0.84 (1)	10.00			
O-N	0 / 2489	-18.5	-18.5 0.54 (1)	10.00			
N-M	0 / 2489	-18.5	-18.5 0.54 (1)	10.00			
M-L	0 / 2417	-18.5	-18.5 0.53 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TRG 2011, TRG 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.41")

CS1: TC=0.95/1.00 (D-E:1), BC=0.64/1.00 (O-P:1),
WB=0.83/1.00 (I-L:1), SS=0.28/1.00 (D-E:1).

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1887 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.89 (L) (INPUT = 0.80)
JSI METAL= 0.77 (N) (INPUT = 1.00)



Structural component only
DWG# T-2007170

JOB NAME 408170	TRUSS NAME T42	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 26 13:02:19 2020 Page 1
ID:K7TPdghi0npl1qlydbWIOFzideG-WE2rKaEwWzr9THdaVEQJEKBSUWUW4PP4adqo5FzNB1Y
Scale = 1:57.3

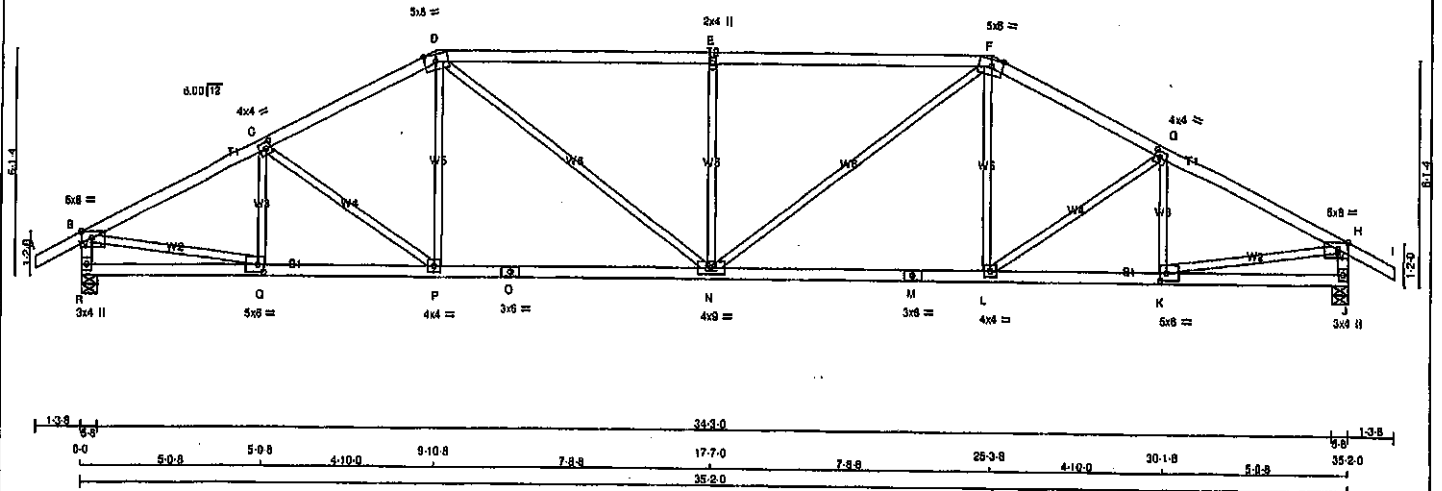

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - I	2x4	DRY No.2	SPF
R - B	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
R - O	2x4	DRY No.2	SPF
O - M	2x4	DRY No.2	SPF
M - J	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMW-p	MT20	5.0	8.0 Edge 3.50
C	TMWV-I	MT20	4.0	4.0 2.00 1.75
D	TTWV-m	MT20	5.0	8.0 2.25 3.75
E	TMW-w	MT20	2.0	4.0
F	TTWV-m	MT20	5.0	8.0 2.25 3.75
G	TMWV-I	MT20	4.0	4.0 2.00 1.75
H	TMW-p	MT20	5.0	8.0 Edge 3.50
J	BMV-I-p	MT20	3.0	4.0
K	BMWV-I	MT20	5.0	8.0 2.50 2.00
L	BMWV-I	MT20	4.0	4.0
M	BS-I	MT20	3.0	8.0
N	BMWV-I	MT20	4.0	9.0
O	BS-I	MT20	3.0	8.0
P	BMWV-I	MT20	4.0	4.0
Q	BMWV-I	MT20	5.0	8.0 2.50 2.00
R	BMV-I-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
R	2083	0	2083	0	5-8
J	2083	0	2083	0	5-8

UNFACTORED REACTIONS		1ST LCASE	MAX./MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
R	1457	988 / 0	0 / 0
J	1457	988 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.78 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED	FACTORED	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	LC1	MAX	MEMB.	FORCE	MAX	MAX
FR-TO	(LBS)	FROM TO	CSI (LC)	UNBRACED LENGTH	FR-TO	(LBS)	CSI (LC)	UNBRACED LENGTH
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	Q-C	-353 / 0	0.08 (1)
B-C	-2834 / 0	-91.8	-91.8	0.39 (1)	3.81	C-P	-210 / 0	0.13 (1)
C-D	-2887 / 0	-91.8	-91.8	0.37 (1)	3.81	P-D	0 / 248	0.08 (4)
D-E	-3050 / 0	-91.8	-91.8	0.97 (1)	2.78	D-N	0 / 844	0.19 (1)
E-F	-3050 / 0	-91.8	-91.8	0.97 (1)	2.78	N-E	-872 / 0	0.51 (1)
F-G	-2887 / 0	-91.8	-91.8	0.37 (1)	3.81	N-F	0 / 844	0.19 (1)
G-H	-2834 / 0	-91.8	-91.8	0.39 (1)	3.81	L-F	0 / 246	0.08 (4)
H-I	0 / 28	-91.8	-91.8	0.12 (1)	10.00	L-G	-210 / 0	0.13 (1)
R-B	-2018 / 0	0.0	0.0	0.20 (1)	5.94	K-G	-383 / 0	0.08 (1)
J-H	-2018 / 0	0.0	0.0	0.20 (1)	5.94	B-Q	0 / 2591	0.58 (1)
R-Q	0 / 0	-18.5	-18.5	0.10 (4)	10.00	K-H	0 / 2591	0.58 (1)
Q-P	0 / 2555	-18.5	-18.5	0.51 (1)	10.00			
P-O	0 / 2388	-18.5	-18.5	0.49 (1)	10.00			
O-N	0 / 2388	-18.5	-18.5	0.49 (1)	10.00			
N-M	0 / 2388	-18.5	-18.5	0.49 (1)	10.00			
M-L	0 / 2388	-18.5	-18.5	0.49 (1)	10.00			
L-K	0 / 2555	-18.5	-18.5	0.51 (1)	10.00			
K-J	0 / 0	-18.5	-18.5	0.10 (4)	10.00			

TOTAL WEIGHT = 2 X 139 = 277 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2010, NBCC 2016

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/989 (0.17")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/989 (0.34")

CSI: TC=0.97/1.00 (D-E:1), BC=0.51/1.00 (P-Q:1), WB=0.58/1.00 (B-Q:1), SS=0.34/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PLJ)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1688

PLATE PLACEMENT TOL. = 0.280 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP=0.87 (F) (INPUT = 0.90)
JSI METAL=0.75 (M) (INPUT = 1.00)

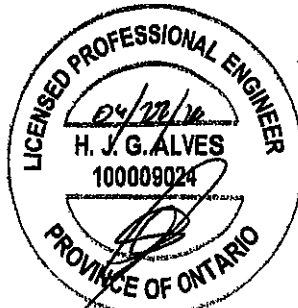

Structural component only
DWG# T-2007171

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T43	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 5 Oct 2018 MITK Industries, Inc. Sat Apr 25 13:02:20 2020 Page 1
ID:K?TPdHgJ0np1tqYobWtOFzdeG- GcEYwFYHHz04RCm3xxynXkMwQpsVEoHZLdzNB1X

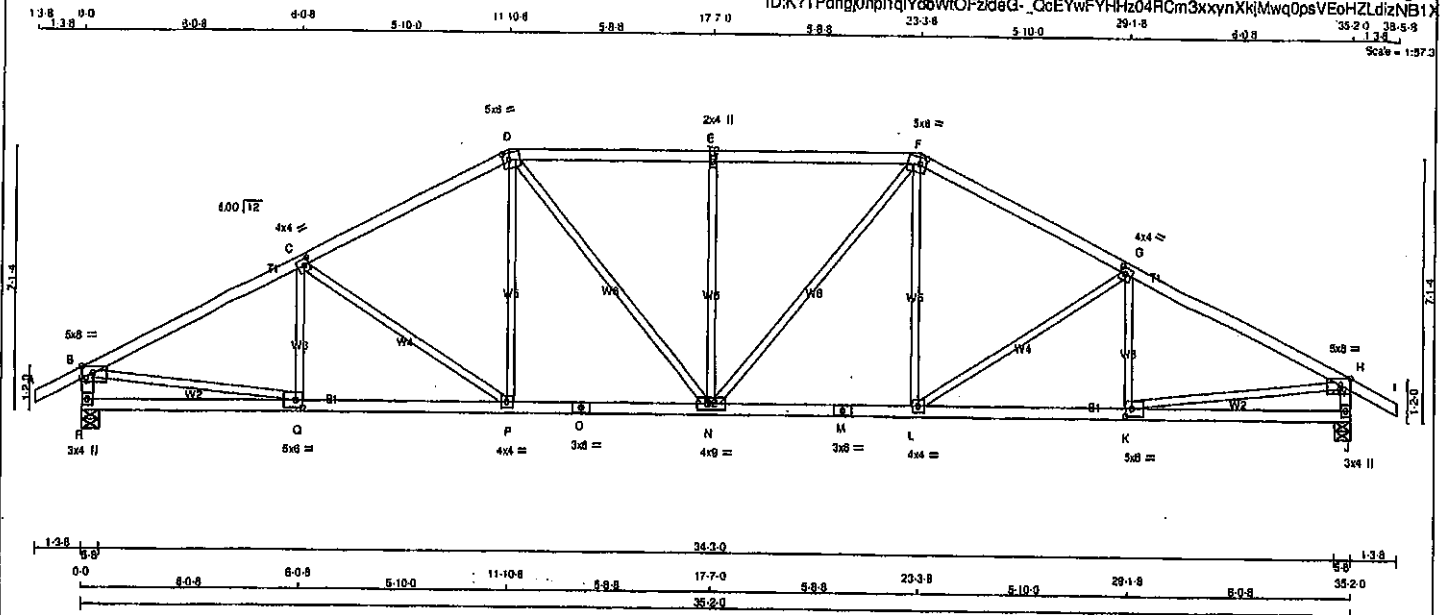

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - F	2x4	DRY	No.2	SPF		
F - I	2x4	DRY	No.2	SPF		
R - B	2x4	DRY	No.2	SPF		
J - H	2x4	DRY	No.2	SPF		
R - O	2x4	DRY	No.2	SPF		
O - M	2x4	DRY	No.2	SPF		
M - J	2x4	DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2
EXCEPT
DRY: SEASONED LUMBER.

PLATES (inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge 3.50	
C	TMVW-l	MT20	4.0	4.0	2.00 1.75	
D	TTWV-m	MT20	5.0	8.0	2.25 2.00	
E	TMVW-w	MT20	2.0	4.0		
F	TTWV-m	MT20	5.0	8.0	2.25 2.00	
G	TMVW-l	MT20	4.0	4.0	2.00 1.75	
H	TMVW-p	MT20	5.0	8.0	Edge 3.50	
J	BMV1+p	MT20	3.0	4.0		
K	BMVW-l	MT20	5.0	8.0	2.50 2.25	
L	BMVW-l	MT20	4.0	4.0		
M	BS-l	MT20	3.0	8.0		
N	BMVW-l	MT20	4.0	4.0		
O	BS-l	MT20	3.0	8.0		
P	BMVW-l	MT20	4.0	4.0		
Q	BMVW-l	MT20	5.0	8.0	2.50 2.25	
R	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
R	2063	0	0	2063	0	0	0	5-8	5-8
J	2063	0	0	2063	0	0	0	5-8	5-8

UNFACTORED REACTIONS		1ST LOOSE		MAX/MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
R	1457	989 / 0	0 / 0	0 / 0	0 / 0
J	1457	989 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LOI (PLF)	MAX CSI (LO)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LO)	
FR-TO		FROM TO			FR-TO			
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	Q-C	-285 / 12	0.07 (1)
B-C	-2889 / 0	-91.8	-91.8	0.58 (1)	3.58	G-P	-435 / 0	0.42 (1)
C-D	-2839 / 0	-91.8	-91.8	0.52 (1)	3.85	P-D	0 / 360	0.08 (1)
D-E	-2559 / 0	-91.8	-91.8	0.46 (1)	3.85	D-N	0 / 482	0.11 (1)
E-F	-2560 / 0	-91.8	-91.8	0.48 (1)	3.85	N-E	-641 / 0	0.58 (1)
F-G	-2539 / 0	-91.8	-91.8	0.82 (1)	3.85	N-F	0 / 482	0.11 (1)
G-H	-2889 / 0	-91.8	-91.8	0.58 (1)	3.58	L-F	0 / 360	0.09 (1)
H-I	0 / 28	-91.8	-91.8	0.12 (1)	10.00	L-G	-438 / 0	0.42 (1)
R-B	-2014 / 0	0.0	0.0	0.20 (1)	5.95	K-G	-255 / 12	0.07 (1)
J-H	-2014 / 0	0.0	0.0	0.20 (1)	5.95	B-Q	0 / 2835	0.59 (1)
						K-H	0 / 2835	0.59 (1)
R-Q	0 / 0	-18.5	-18.5	0.15 (4)	10.00			
Q-P	0 / 2809	-18.5	-18.5	0.49 (1)	10.00			
P-O	0 / 2249	-18.5	-18.5	0.43 (1)	10.00			
O-N	0 / 2249	-18.5	-18.5	0.43 (1)	10.00			
N-M	0 / 2249	-18.5	-18.5	0.43 (1)	10.00			
M-L	0 / 2249	-18.5	-18.5	0.43 (1)	10.00			
L-K	0 / 2809	-18.5	-18.5	0.49 (1)	10.00			
K-J	0 / 0	-18.5	-18.5	0.15 (4)	10.00			

TOTAL WEIGHT = 2 X 145 = 289 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 8.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.15")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.28")

CS: TC=0.58/1.00 (B-C:1), BC=0.49/1.00 (P-Q:1), WB=0.59/1.00 (B-Q:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (Q) (INPUT = 0.90)
JSI METAL = 0.89 (M) (INPUT = 1.00)




Structural component only
DWG# T-2007172

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T44	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 26 13:02:21 2020 Page 1
ID:K?TPdhpj0npl1qYdbWfOFzideG-SdAcIGGA2a5libryciSBKIGrDK9jYJhN1xJv88zNB1W

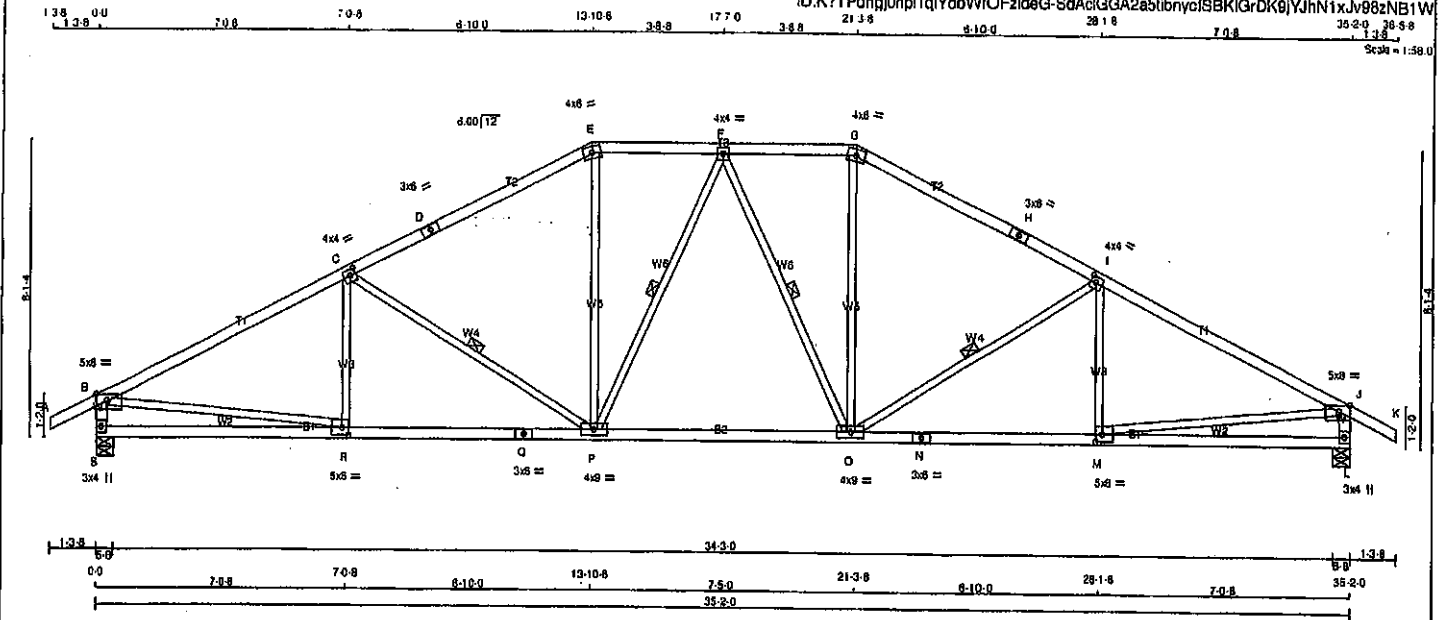

TOTAL WEIGHT = 2 X 145 = 291 lb
(M/F)

LUMBER

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - E	2x4	DRY No.2	SPF
E - G	2x4	DRY No.2	SPF
G - H	2x4	DRY No.2	SPF
H - K	2x4	DRY No.2	SPF
S - B	2x4	DRY No.2	SPF
L - J	2x4	DRY No.2	SPF
S - Q	2x4	DRY No.2	SPF
Q - N	2x4	DRY No.2	SPF
N - L	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY; SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMWV-p	MT20	5.0	8.0	Edge	3.50
C TMWV-l	MT20	4.0	4.0	2.00	1.75
D TS-1	MT20	3.0	8.0		
E TTW-m	MT20	4.0	8.0		
F TMWV-l	MT20	4.0	4.0		
G TTW-m	MT20	4.0	8.0		
H TS-1	MT20	3.0	8.0		
I TMWV-l	MT20	4.0	4.0	2.00	1.75
J TMWV-p	MT20	5.0	8.0	Edge	3.50
L BMV-l-p	MT20	3.0	4.0		
M BMWV-l	MT20	5.0	8.0	2.50	2.25
N BS-1	MT20	3.0	8.0		
O BMWV-l	MT20	4.0	8.0		
P BMWV-l	MT20	4.0	8.0		
Q BS-1	MT20	3.0	8.0		
R BMWV-l	MT20	5.0	8.0	2.50	2.25
S BMV-l-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
S	2063	0	2063	0	0	5-8	5-8		
L	2063	0	2063	0	0	5-8	5-8		

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-P, F-P, F-Q, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	CS1 (LC)	MEMB.	FORCE (LBS)	CS1 (LC)	CS1 (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	R-C	-182 / 52	0.08 (1)
B-C	-2806 / 0	-91.8	-91.8 0.83 (1)	3.25	C-P	-637 / 0	0.29 (1)
C-D	-2373 / 0	-91.8	-91.8 0.72 (1)	3.88	P-E	0 / 674	0.15 (1)
D-E	-2373 / 0	-91.8	-91.8 0.72 (1)	3.88	F-F	-222 / 0	0.11 (1)
E-F	-2100 / 0	-91.8	-91.8 0.19 (1)	4.53	F-O	-222 / 0	0.11 (1)
F-G	-2100 / 0	-91.8	-91.8 0.19 (1)	4.53	O-G	0 / 674	0.15 (1)
G-H	-2373 / 0	-91.8	-91.8 0.72 (1)	3.68	O-I	-837 / 0	0.29 (1)
H-I	-2373 / 0	-91.8	-91.8 0.72 (1)	3.68	M-I	-182 / 52	0.08 (1)
I-J	-2806 / 0	-91.8	-91.8 0.83 (1)	3.25	B-R	0 / 2849	0.80 (1)
J-K	0 / 28	-91.8	-91.8 0.12 (1)	10.00	M-J	0 / 2849	0.80 (1)
S-B	-2008 / 0	0.0	0.0 0.20 (1)	5.98			
L-J	-2008 / 0	0.0	0.0 0.20 (1)	5.98			
S-R	0 / 0	-18.5	-18.5 0.20 (4)	10.00			
R-Q	0 / 2830	-18.5	-18.5 0.52 (1)	10.00			
C-P	0 / 2830	-18.5	-18.5 0.52 (1)	10.00			
P-O	0 / 2193	-18.5	-18.5 0.45 (1)	10.00			
O-N	0 / 2830	-18.5	-18.5 0.52 (1)	10.00			
N-M	0 / 2830	-18.5	-18.5 0.52 (1)	10.00			
M-L	0 / 0	-18.5	-18.5 0.20 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/D

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CS1: TC=0.83/1.00 (B-C:1), BC=0.52/1.00 (P-R:1),
WB=0.60/1.00 (B-R:1), SS1=0.28/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 610 354 1687 788 1987 1858


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (M) (INPUT = 0.90)
JSI METAL = 0.79 (Q) (INPUT = 1.00)

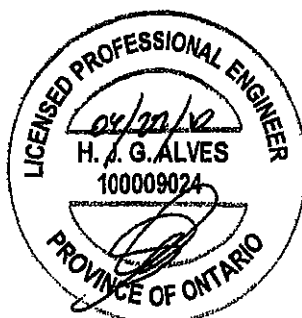


Structural component only
DWG# T-2007173

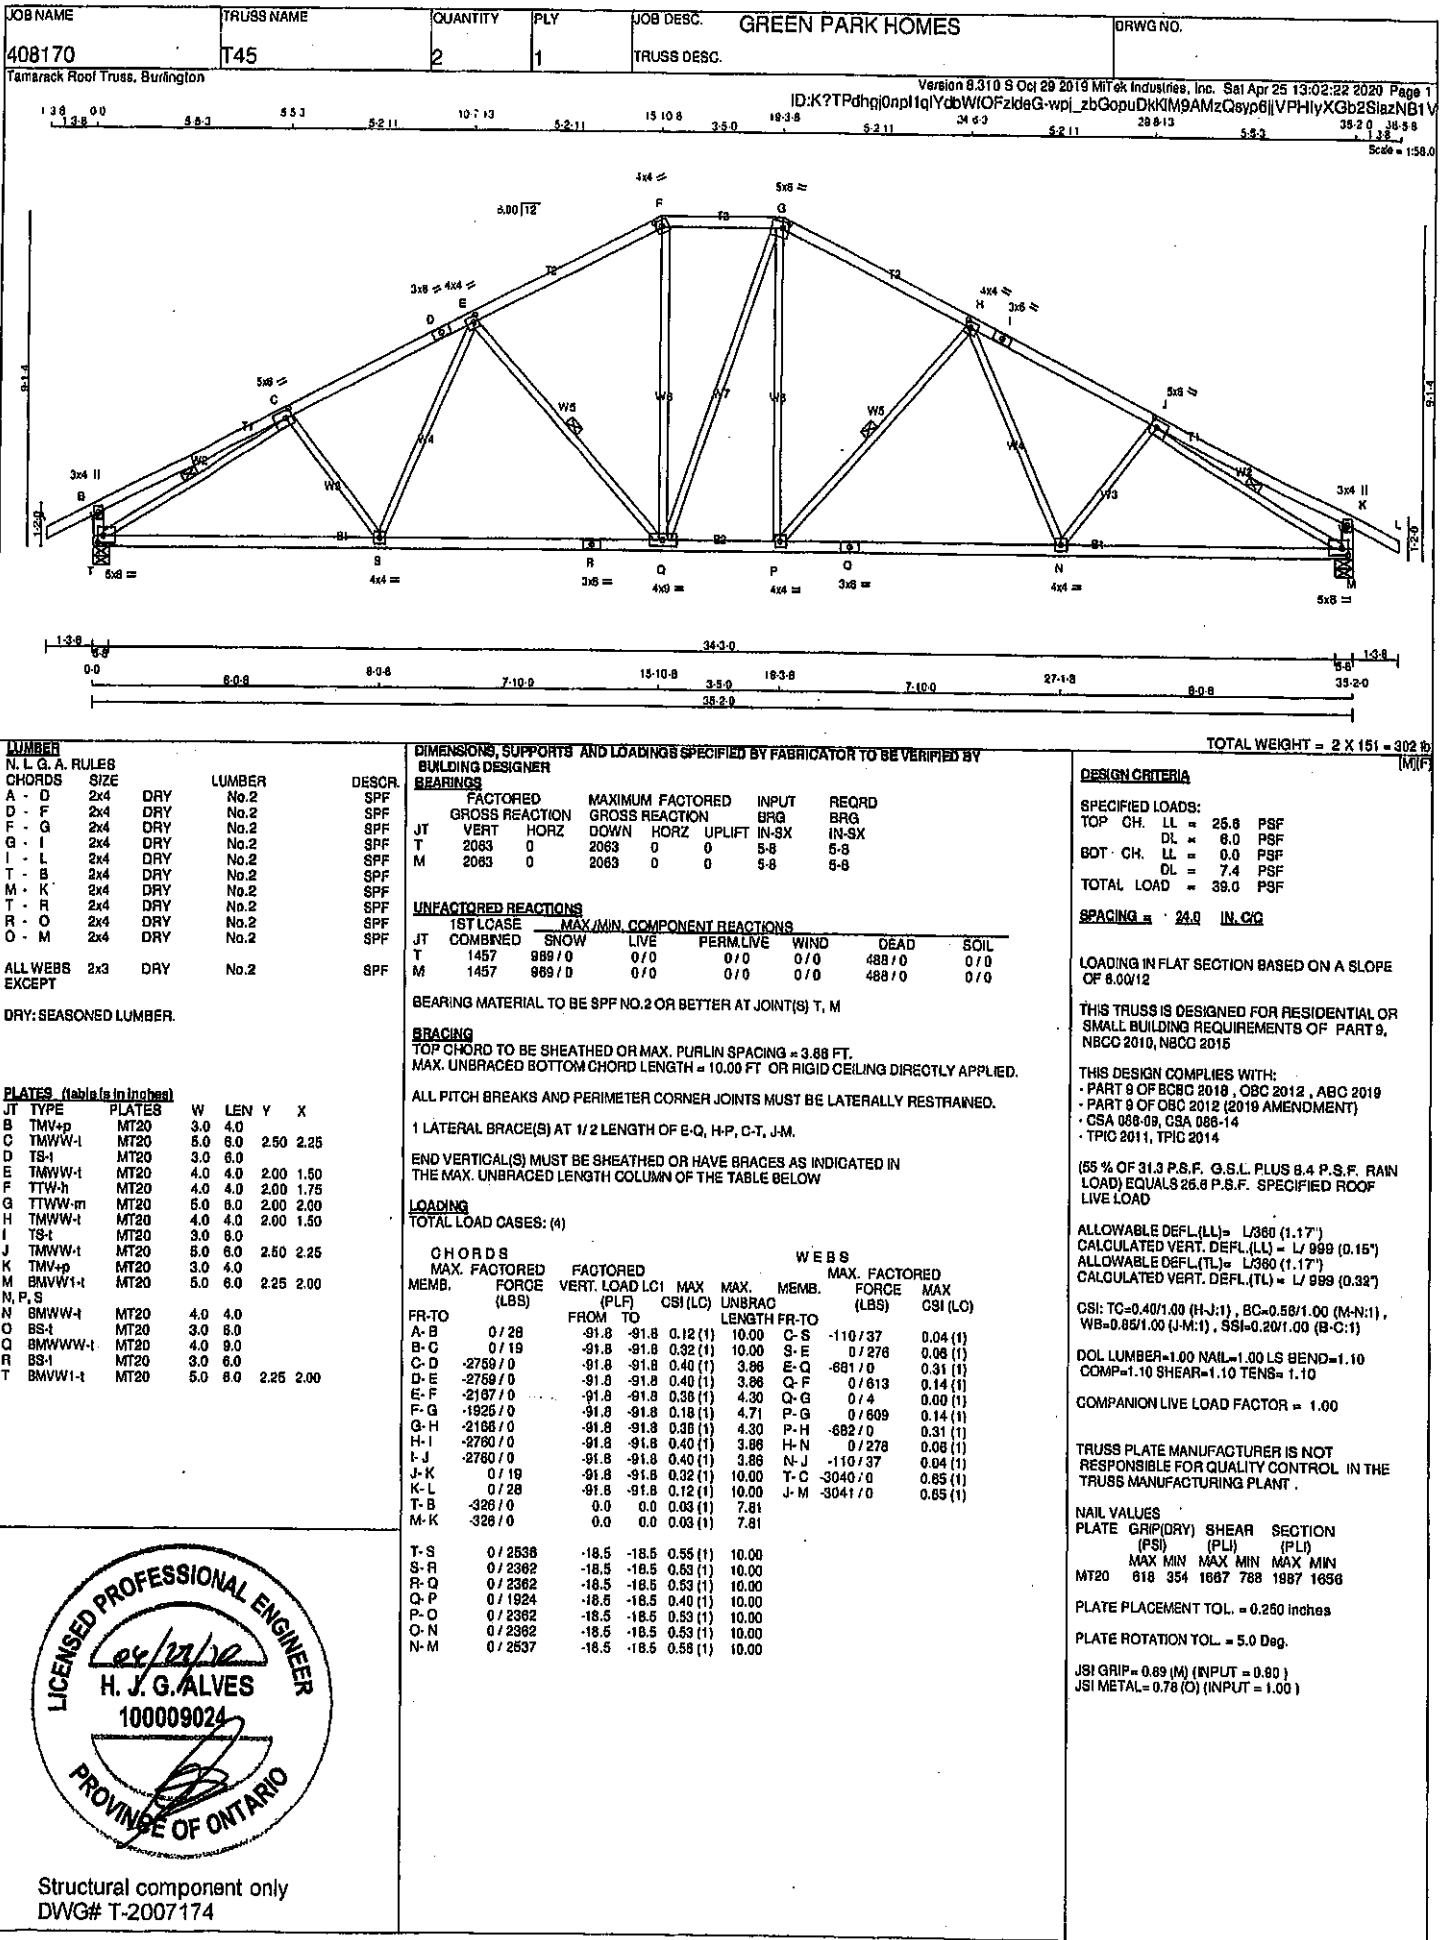

JOB NAME 408170	TRUSS NAME T46	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamareck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 13:02:23 2020 Page 1
ID:K?TPdhgDnpl1qIYabWfOfzIdG-O?HMAxHQaCLbxuLk4UfPALGz7q50ADgUfo7E1zNB1U

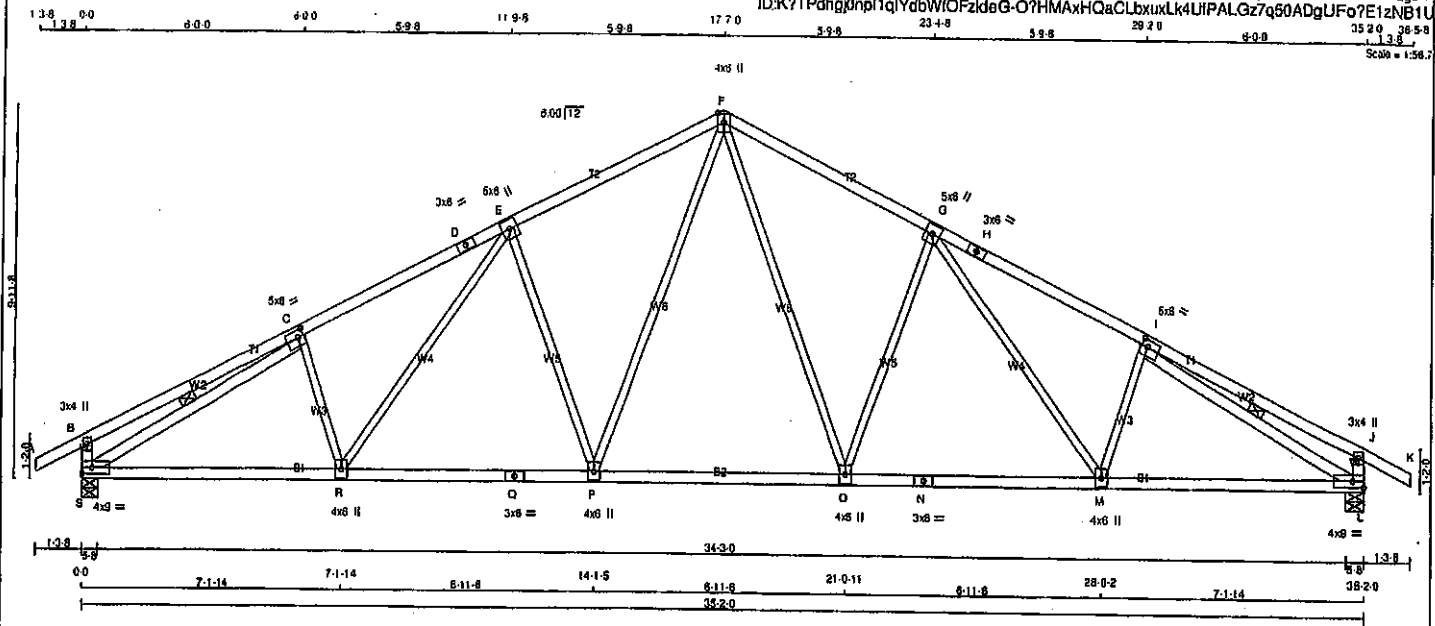

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
C	TMWW-t	MT20	5.0	8.0 2.25 2.00
D	TS-t	MT20	3.0	8.0
E	TMWW-t	MT20	5.0	8.0
F	TTWW+p	MT20	4.0	8.0 Edge
G	TMWW-t	MT20	5.0	8.0
H	TS-t	MT20	3.0	8.0
I	TMWW-t	MT20	5.0	8.0 2.25 2.00
J	TMV+p	MT20	3.0	4.0
L	BMVW-t	MT20	4.0	9.0 Edge
M	BMWW-t	MT20	4.0	8.0
N	BS-t	MT20	3.0	8.0
Q	BS-t	MT20	3.0	8.0
S	BMVW-t	MT20	4.0	9.0 Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	GROSS REACTION	DOWN	BRG	BRG
S	2063	0	2063	0	5-8
L	2063	0	2063	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND
S	1457	989 / 0	0 / 0	0 / 0	488 / 0
L	1457	989 / 0	0 / 0	0 / 0	488 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.76 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, I-L

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LG1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM	TO	FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	F-O	0 / 886	0.19 (1)
B-C	0 / 22	-91.8	-91.8 0.40 (1)	10.00	O-G	-728 / 0	0.72 (1)
C-D	-2808 / 0	-91.8	-91.8 0.49 (1)	3.75	G-M	0 / 391	0.08 (1)
D-E	-2808 / 0	-91.8	-91.8 0.49 (1)	3.75	M-I	-192 / 18	0.05 (1)
E-F	-2322 / 0	-91.8	-91.8 0.48 (1)	4.07	P-F	0 / 886	0.19 (1)
F-G	-2322 / 0	-91.8	-91.8 0.48 (1)	4.07	E-P	-728 / 0	0.72 (1)
G-H	-2808 / 0	-91.8	-91.8 0.49 (1)	3.75	R-E	0 / 391	0.09 (1)
H-I	-2808 / 0	-91.8	-91.8 0.49 (1)	3.75	C-R	-192 / 18	0.05 (1)
I-J	0 / 22	-91.8	-91.8 0.40 (1)	10.00	S-C	-3084 / 0	0.72 (1)
J-K	0 / 28	-91.8	-91.8 0.12 (1)	10.00	I-L	-3084 / 0	0.72 (1)
S-B	-344 / 0	0.0	0.0 0.03 (1)	7.81			
L-J	-344 / 0	0.0	0.0 0.03 (1)	7.81			
S-R	0 / 2574	-18.5	-18.5 0.53 (1)	10.00			
R-Q	0 / 2291	-18.5	-18.5 0.47 (1)	10.00			
Q-P	0 / 2291	-18.5	-18.5 0.47 (1)	10.00			
P-O	0 / 1762	-18.5	-18.5 0.38 (1)	10.00			
O-N	0 / 2291	-18.5	-18.5 0.47 (1)	10.00			
N-M	0 / 2291	-18.5	-18.5 0.47 (1)	10.00			
M-L	0 / 2574	-18.5	-18.5 0.53 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (1.17)
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.14)
ALLOWABLE DEFL. (TL) = $L/360$ (1.17)
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.28)

CSK: TC=0.49/1.00 (G-I), BC=0.53/1.00 (R-S), WB=0.72/1.00 (E-P), SS=0.22/1.00 (B-C)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE FEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (C) (INPUT = 0.80)
JSI METAL = 0.77 (I) (INPUT = 1.00)



Structural component only
DWG# T-2007175

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T47	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:24 2020 Page 2
ID:K7TPdHg0nq1qYdbWIOFzIdeG-sCrkNH2L.VTS22WXIn?uxNuSFXBotQpivXZmTzNB1T

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	4.0	6.0	1.00	3.00
C	TMWV-l	MT20	4.0	4.0	2.00	1.75
D	TTWV-m	MT20	5.0	6.0	2.25	2.00
E	TMWV-w	MT20	2.0	4.0		
F	TTWV-m	MT20	5.0	6.0	2.25	2.00
G	TMWV-l	MT20	5.0	6.0		Edge
H	BMVl+p	MT20	3.0	6.0		
I	BMWV-l	MT20	5.0	6.0	2.50	2.75
J	BMWVW-l	MT20	5.0	8.0		
K	BS-l	MT20	5.0	6.0		
L	BMWV-l	MT20	5.0	6.0		
M	BMWV-l	MT20	5.0	6.0		
N	BMVl+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2007176 42


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T48	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 26 13:02:26 2020 Page 1					
ID:K7TPdngl0npl1qYdbWIOFzIdaG-LOP7bdJg8pbJBC5kRUX7UbrC0xZ9U3GzyZH6ivzNB1S					
Scale = 1:39.3					

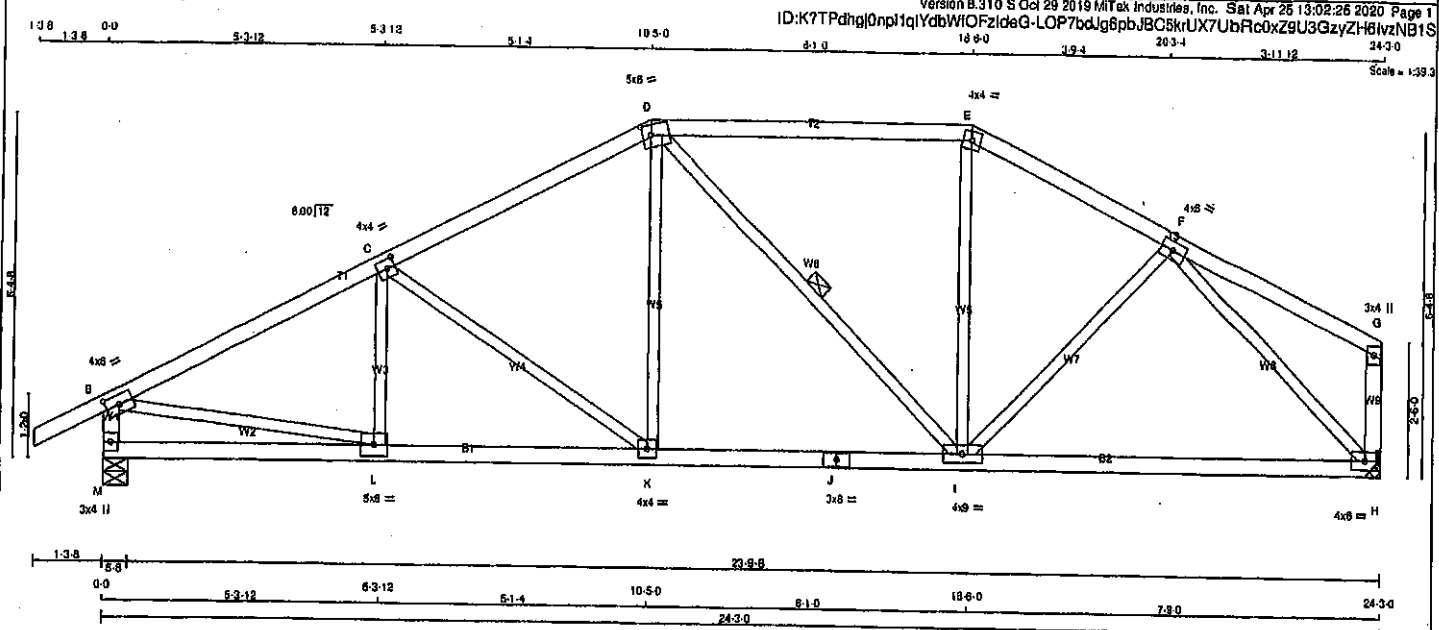

LUMBER				DESIGN CRITERIA			
N. L. G. A. RULES				TOTAL WEIGHT = 89.5			
CHORDS	SIZE	LUMBER	DESCR.	BUILDING DESIGNER			
A - D	2x4	DRY	No.2	BEARINGS			
D - E	2x4	DRY	No.2	FACTORED			
E - G	2x4	DRY	No.2	GROSS REACTION			
M - B	2x4	DRY	No.2	MAXIMUM FACTORED			
H - G	2x4	DRY	No.2	INPUT			
M - J	2x4	DRY	No.2	REGRD			
J - H	2x4	DRY	No.2	BRG			
ALL WEBS 2x3 DRY No.2				IN-SX			
EXCEPT				5-8			
DRY: SEASONED LUMBER.				MECHANICAL			
				A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.			
				UNFACTORED REACTIONS			
				1ST CASE MAX. MIN. COMPONENT REACTIONS			
				JT COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL			
				M 1031 890 / 0 0 / 0 0 / 0 0 / 0 341 / 0 0 / 0			
				H 945 620 / 0 0 / 0 0 / 0 0 / 0 325 / 0 0 / 0			
				BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M			
				BRACING			
				TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.58 FT.			
				MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.			
				ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.			
				1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-I.			
				END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW			
				LOADING			
				TOTAL LOAD CASES: (4)			
				CHORDS			
				MEMB. MAX. FACTORED FORCE (LBS) VERT. LOAD (PLF) MAX. CSF (LC) UNBRACED LENGTH (FT) FR-TO			
				A-B 0 / 28 -91.8 -91.8 0.12 (1) 10.00 L-C -185 / 32 0.04 (1)			
				B-C -1844 / 0 -91.8 -91.8 0.38 (1) 4.58 C-K -438 / 0 0.31 (1)			
				C-D -1488 / 0 -91.8 -91.8 0.34 (1) 5.00 K-D 0 / 334 0.08 (1)			
				D-E -1181 / 0 -91.8 -91.8 0.48 (1) 5.27 D-I -189 / 0 0.09 (1)			
				E-F -1338 / 0 -91.8 -91.8 0.18 (1) 5.42 F-E 0 / 175 0.05 (4)			
				F-G 0 / 18 -91.8 -91.8 0.21 (1) 10.00 F-F 0 / 158 0.04 (4)			
				M-B -1419 / 0 0.0 0.0 0.14 (1) 6.85 B-L 0 / 1692 0.38 (1)			
				H-G -138 / 0 0.0 0.0 0.02 (1) 7.81 F-H -1583 / 0 0.82 (1)			
				M-L 0 / 0 -18.5 -18.5 0.12 (4) 10.00			
				L-K 0 / 1671 -18.5 -18.5 0.32 (1) 10.00			
				K-J 0 / 1313 -18.5 -18.5 0.38 (4) 10.00			
				J-I 0 / 1313 -18.5 -18.5 0.38 (4) 10.00			
				I-H 0 / 1089 -18.5 -18.5 0.34 (4) 10.00			
				WEBS			
				MEMB. MAX. FACTORED FORCE (LBS) MAX. CSF (LC)			
				A-B 0 / 28 -91.8 -91.8 0.12 (1) 10.00 L-C -185 / 32 0.04 (1)			
				B-C -1844 / 0 -91.8 -91.8 0.38 (1) 4.58 C-K -438 / 0 0.31 (1)			
				C-D -1488 / 0 -91.8 -91.8 0.34 (1) 5.00 K-D 0 / 334 0.08 (1)			
				D-E -1181 / 0 -91.8 -91.8 0.48 (1) 5.27 D-I -189 / 0 0.09 (1)			
				E-F -1338 / 0 -91.8 -91.8 0.18 (1) 5.42 F-E 0 / 175 0.05 (4)			
				F-G 0 / 18 -91.8 -91.8 0.21 (1) 10.00 F-F 0 / 158 0.04 (4)			
				M-B -1419 / 0 0.0 0.0 0.14 (1) 6.85 B-L 0 / 1692 0.38 (1)			
				H-G -138 / 0 0.0 0.0 0.02 (1) 7.81 F-H -1583 / 0 0.82 (1)			
				M-L 0 / 0 -18.5 -18.5 0.12 (4) 10.00			
				L-K 0 / 1671 -18.5 -18.5 0.32 (1) 10.00			
				K-J 0 / 1313 -18.5 -18.5 0.38 (4) 10.00			
				J-I 0 / 1313 -18.5 -18.5 0.38 (4) 10.00			
				I-H 0 / 1089 -18.5 -18.5 0.34 (4) 10.00			
				NAIL VALUES			
				PLATE GRP(DRY) SHEAR SECTION			
				(PSI) (PLI) (PLI)			
				MAX MIN MAX MIN MAX MIN			
				MT20 618 334 1887 788 1887 1858			
				PLATE PLACEMENT TOL. = 0.250 inches			
				PLATE ROTATION TOL. = 5.0 Deg.			
				JSI GRP = 0.90 (B) (INPUT = 0.90)			
				JSI METAL = 0.50 (B) (INPUT = 1.00)			




Structural component only
DWG# T-2007177

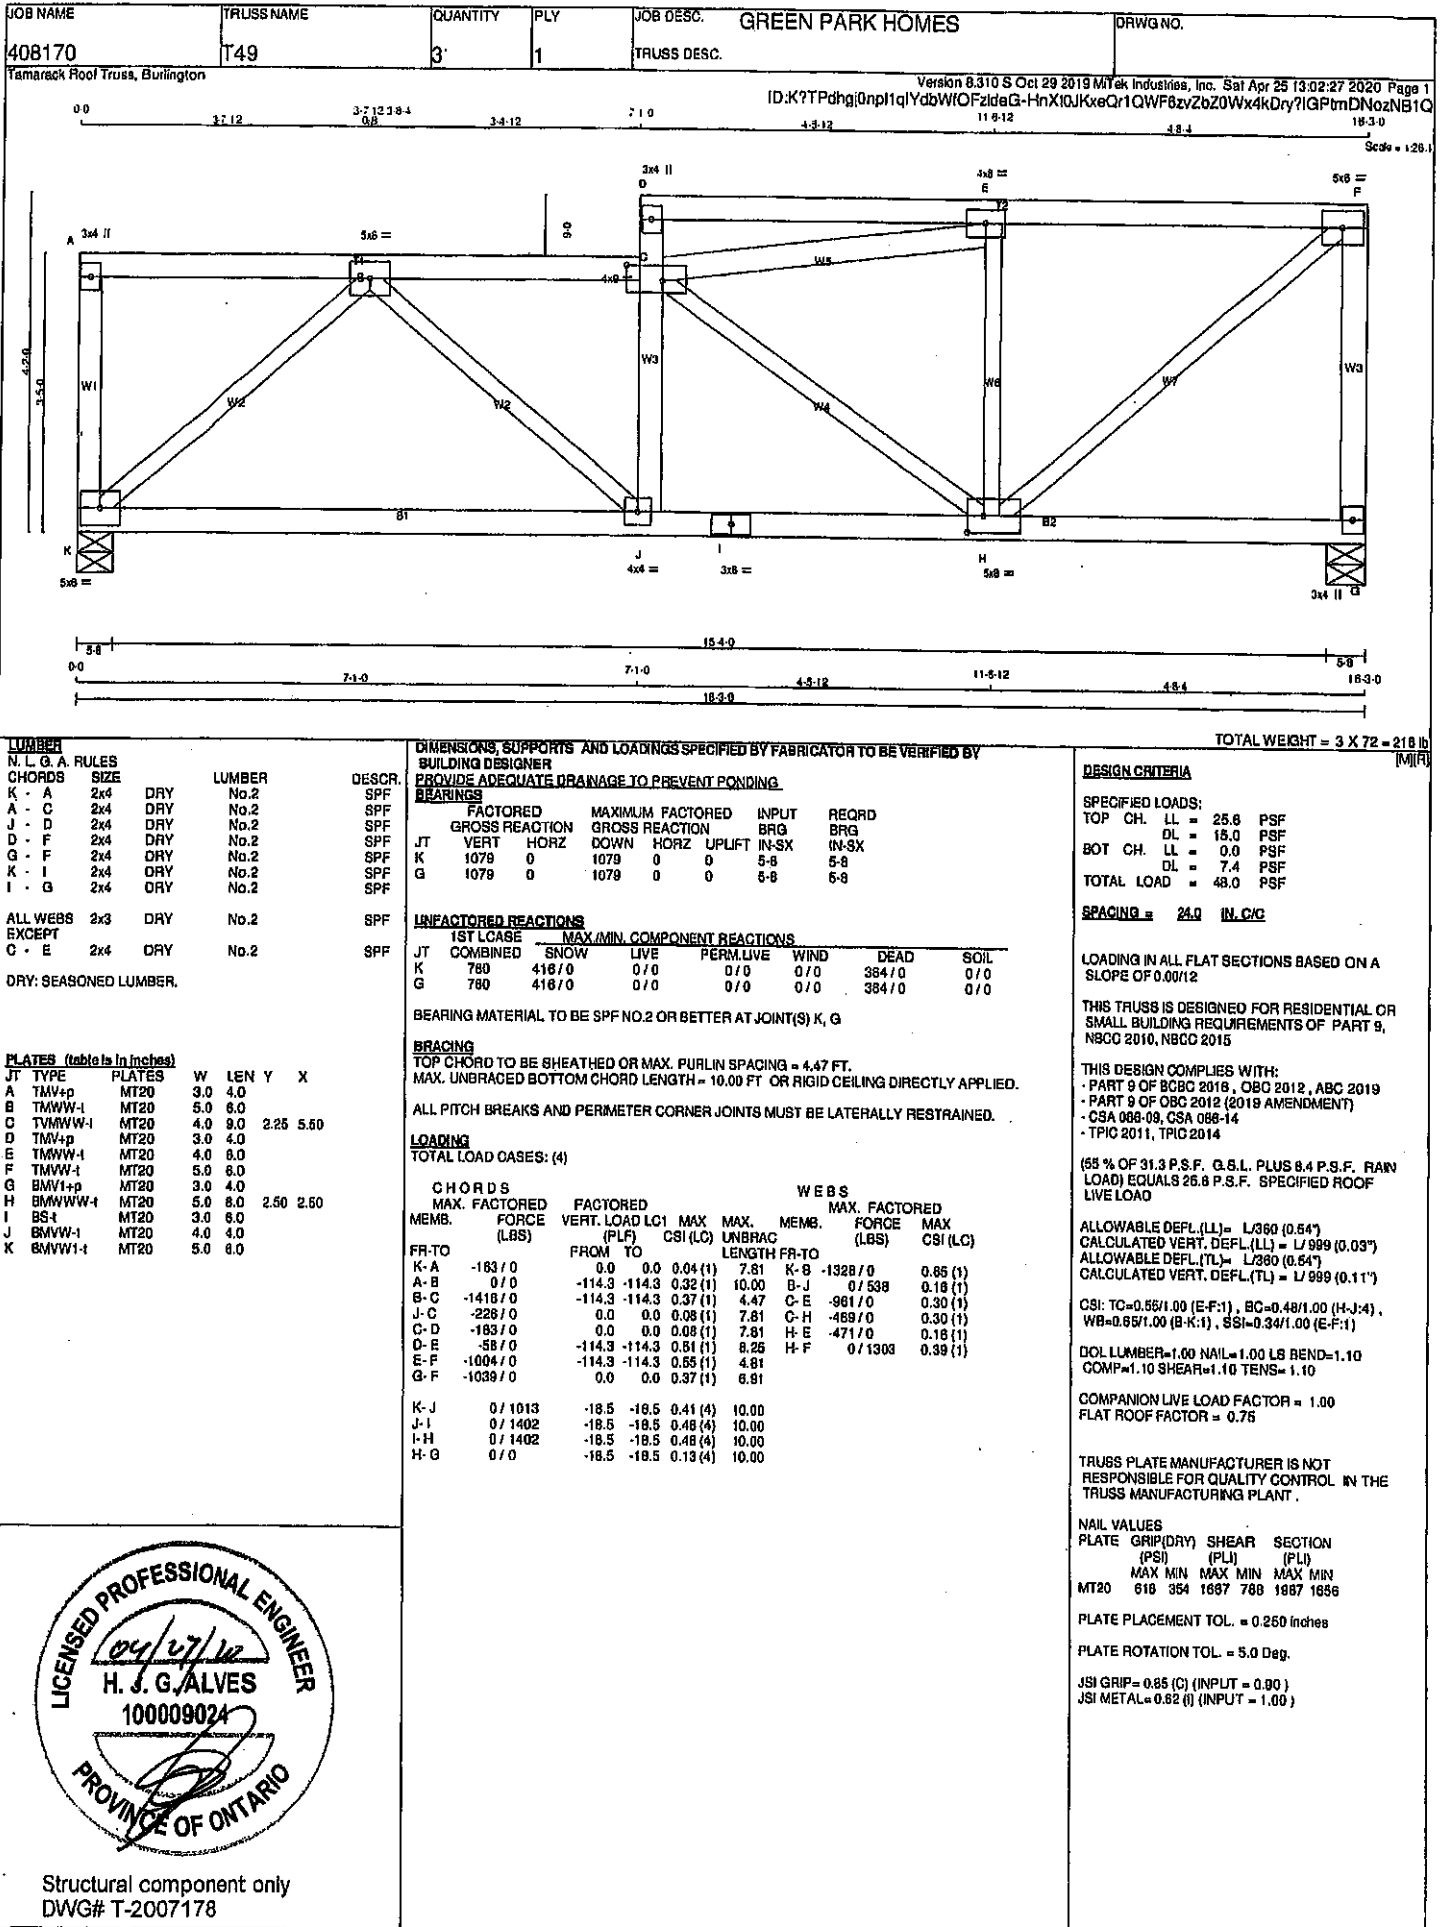

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T50	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 \$ Oct 28 2019 MITek Industries, Inc. Sat Apr 25 13:02:28 2020 Page 1
ID:K?TPchqj0np1tqYdbWIOFzdeG-1z5FDILZPkzu2gpJXd4q6D3AB8cJhXEPeXWmvEzNB1P

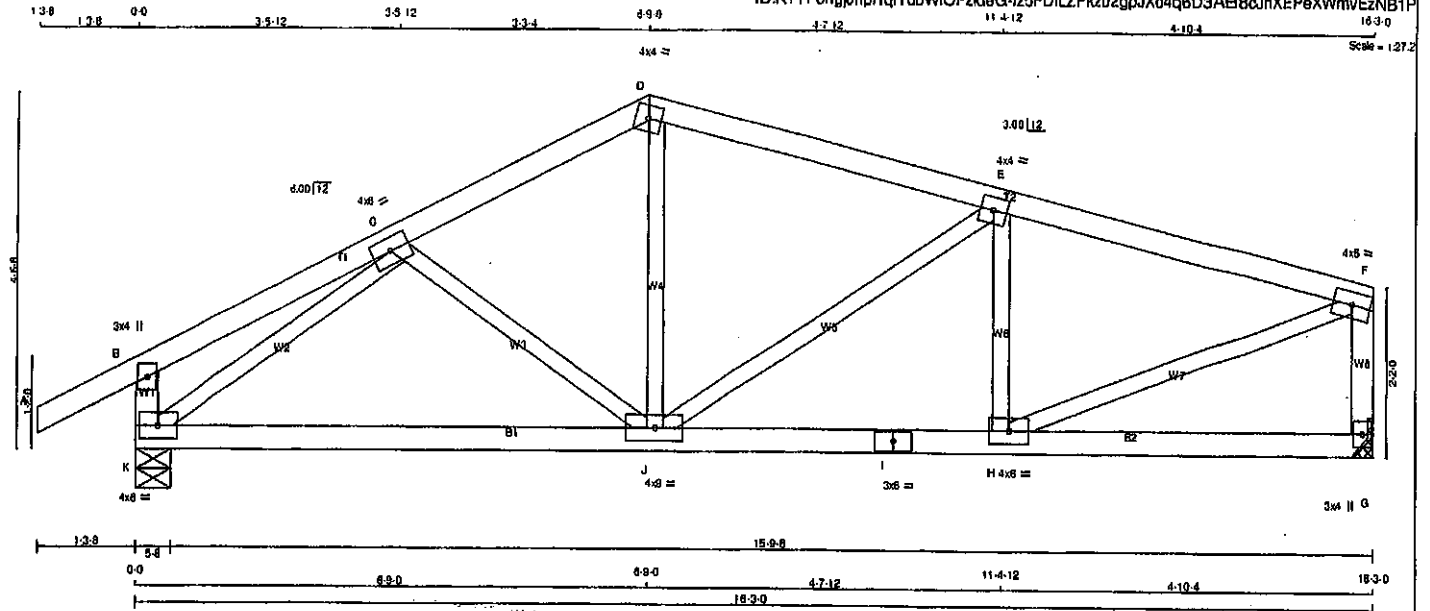

TOTAL WEIGHT = 2 X 63 = 126 lb
(M/F)

LUMBER			
N. L. G. A. RULES	SIZE	DRY	NO.2
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
K - B	2x4	DRY	No.2
G - F	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-1	MT20	4.0	5.0		
D	TTW-1	MT20	4.0	4.0		
E	TMVW-1	MT20	4.0	4.0		
F	TMVW-1	MT20	4.0	5.0		
G	BMV1+p	MT20	3.0	4.0		
H	BMVW-1	MT20	4.0	5.0		
I	BS-1	MT20	3.0	5.0		
J	BMVW-1	MT20	4.0	5.0		
K	BMVW1-1	MT20	4.0	5.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
K	1020	0	1020	0	5-8
G	896	0	896	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	719	485/0	0/0	0/0	0/0	234/0	0/0
G	633	416/0	0/0	0/0	0/0	218/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.73 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO		FROM TO	LENGTH FR-TO
A-B	0/28	-91.8	-91.8 0.12 (1)
B-C	0/14	-91.8	-91.8 0.15 (1)
C-D	-982/0	-91.8	-91.8 0.13 (1)
D-E	-894/0	-91.8	-91.8 0.28 (1)
E-F	-1094/0	-91.8	-91.8 0.27 (1)
K-B	-248/0	0.0	0.0 0.03 (1)
G-F	-855/0	0.0	0.0 0.10 (1)
K-J	0/958	-18.5	-18.5 0.28 (1)
J-I	0/1073	-18.5	-18.5 0.27 (1)
I-H	0/1073	-18.5	-18.5 0.27 (1)
H-G	0/0	-18.5	-18.5 0.10 (4)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
OL = 8.0 PSF
BOT CH. LL = 0.0 PSF
OL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.54")
CALCULATED VERT. DEFL. (LL) = 1/999 (0.03")
ALLOWABLE DEFL. (TL) = L/360 (0.54")
CALCULATED VERT. DEFL. (TL) = 1/999 (0.03")

CSI: TC=0.27/1.00 (E-F:1), BC=0.27/1.00 (H-J:1),
WB=0.35/1.00 (C-K:1), SS=0.21/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1667 758 1987 1656

PLATE PLACEMENT TOL. = 0.260 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.71 (H) (INPUT = 0.90)
JSI METAL= 0.32 (I) (INPUT = 1.00)




Structural component only
DWG# T-2007179

JOB NAME 408170	TRUSS NAME T51	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:29 2020 Page 1
ID:K?TPdhgJ0np1qIYdbWIOFzIdG-D9/dR?MBA25IpOV4Kb3eRbKcYx2QzGZIBFKSgzNB1C

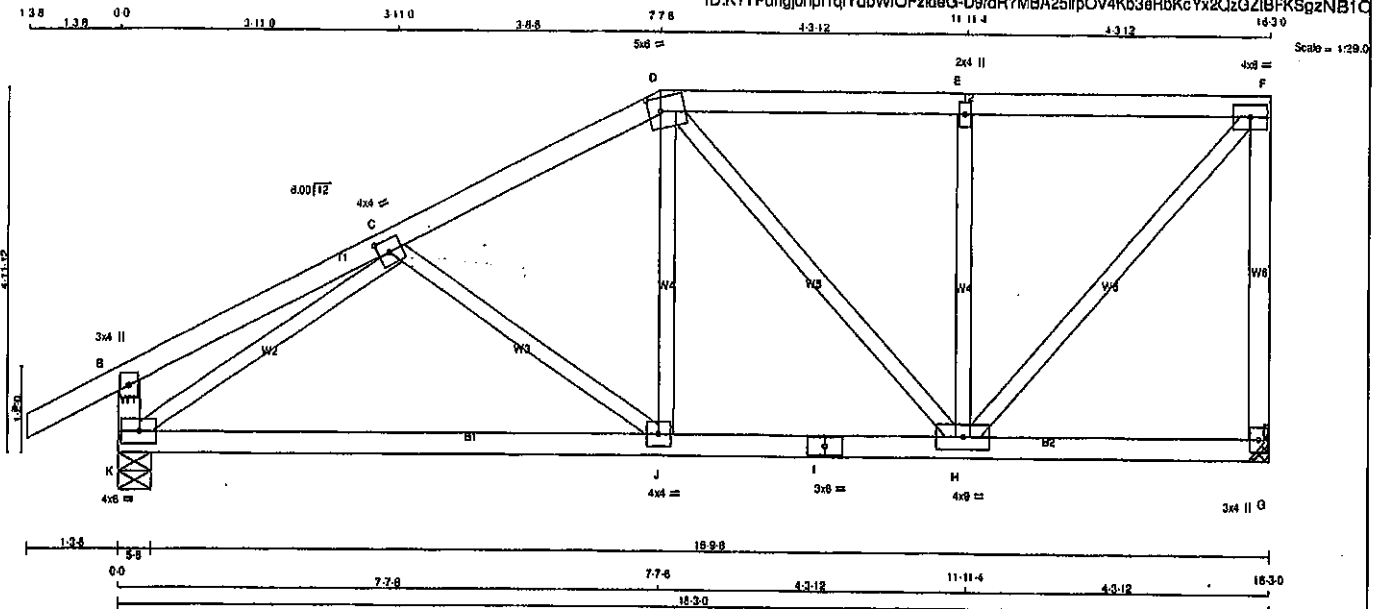

TOTAL WEIGHT = 70 lb (M)

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
G - F	2x4	DRY	No.2
K - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
C	TMWW-t	MT20	4.0	4.0 2.00 1.75
D	TTWW-m	MT20	5.0	6.0 2.25 2.00
E	TMV+w	MT20	2.0	4.0
F	TMV-w	MT20	4.0	6.0
G	BMV1+p	MT20	3.0	4.0
H	BMVWW-t	MT20	4.0	6.0
I	BS-t	MT20	3.0	6.0
J	BMVW-t	MT20	4.0	4.0
K	BMVW-t	MT20	4.0	6.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	VERT	GROSS	REACTION	GROSS	REACTION	BRG	BRG	IN-SX	IN-SX
G	888	0	888	0	0	5-8	5-8		
K	1020	0	1020	0	0	5-8	5-8		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

1ST CASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
G	833	418 / 0	0 / 0	0 / 0	0 / 0	218 / 0	0 / 0
K	719	485 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.21 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD LC1	MAX. FACTORED	MEMB.	MAX. FACTORED	FACTORED
	FORCE (LBS)	VERT. LOAD (PLF)	CS1 (LC)	UNBRACED LENGTH		FORCE (LBS)	CS1 (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	C-J	-215 / 0	0.08 (1)
B-C	0 / 17	-91.8	-91.8 0.20 (1)	10.00	J-D	0 / 288	0.08 (1)
C-D	-801 / 0	-91.8	-91.8 0.22 (1)	6.21	D-H	-210 / 0	0.14 (1)
D-E	-854 / 0	-91.8	-91.8 0.29 (1)	6.25	H-E	-488 / 0	0.18 (1)
E-F	-854 / 0	-91.8	-91.8 0.29 (1)	6.25	H-F	0 / 981	0.22 (1)
G-F	-858 / 0	0.0	0.0 0.35 (1)	7.81	K-C	-1192 / 0	0.43 (1)
K-B	-281 / 0	0.0	0.0 0.03 (1)	7.81			
K-J	0 / 885	-18.5	-18.5 0.30 (4)	10.00			
J-I	0 / 798	-18.5	-18.5 0.30 (4)	10.00			
I-H	0 / 798	-18.5	-18.5 0.30 (4)	10.00			
H-G	0 / 0	-18.5	-18.5 0.08 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.64")
CALCULATED VERT. DEFL.(LL) = 1/998 (0.02")
ALLOWABLE DEFL.(TL) = L/380 (0.64")
CALCULATED VERT. DEFL.(TL) = 1/998 (0.12")

CS1 TO=0.35/1.00 (F-G:1), BC=0.30/1.00 (J-K:4), WB=0.43/1.00 (C-K:1), GS1=0.19/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1687 788	1987 1856

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.88 (C) (INPUT = 0.90)
JSI METAL = 0.40 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007180

JOB NAME 408170	TRUSS NAME G52	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Sat Apr 25 13:02:13 2020 Page 1
ID:K?TPdhgJ0npl1qYdbWOFzIdeG-h4ha4W99x740lMAQ9zJJ73x05YfgpCBINUicZNB1e

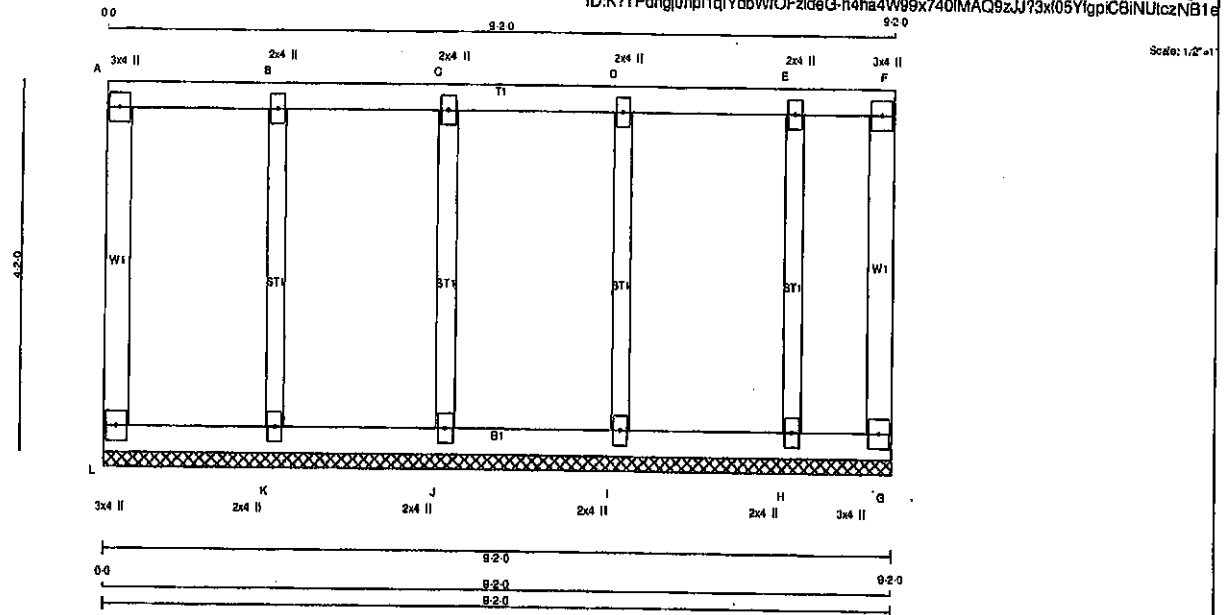

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
L - A	2x4	DRY	No.2	SPF	
A - F	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
L - G	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
ALL GABLE WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B, C, D, E						
B	TMW+w	MT20	2.0	4.0		
F	TMV+p	MT20	3.0	4.0		
G	BMV1+p	MT20	3.0	4.0		
H, I, J, K						
H	BMW1+w	MT20	2.0	4.0		
L	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING.

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	WEBS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX
MEMB.	FORCE (LBS)	FROM	TO	PLF	CSI (LC)	MEMB.	FORCE (LBS)	FROM	TO	PLF	CSI (LC)
L-A	-100 / 0	0.0	0.0	0.02 (1)	7.81	K-B	-245 / 0	0.09 (1)			
A-B	-4 / 0	-114.3	-114.3	0.09 (1)	10.00	J-C	-224 / 0	0.08 (1)			
B-C	-4 / 0	-114.3	-114.3	0.08 (1)	10.00	I-D	-238 / 0	0.08 (1)			
C-D	-4 / 0	-114.3	-114.3	0.07 (1)	10.00	H-E	-188 / 0	0.06 (1)			
D-E	-4 / 0	-114.3	-114.3	0.07 (1)	10.00						
E-F	-4 / 0	-114.3	-114.3	0.05 (1)	10.00						
G-F	-54 / 0	0.0	0.0	0.02 (1)	7.81						

L-K	0 / 4	-18.5	-18.5	0.02 (4)	10.00
K-J	0 / 4	-18.5	-18.5	0.02 (4)	10.00
J-I	0 / 4	-18.5	-18.5	0.02 (4)	10.00
I-H	0 / 4	-18.5	-18.5	0.02 (4)	10.00
H-G	0 / 4	-18.5	-18.5	0.01 (4)	10.00

TOTAL WEIGHT = 41 lb (M/R)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	15.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	48.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.08/1.00 (B-C:1), BC=0.02/1.00 (J-K:4), WB=0.09/1.00 (B-K:1), SS=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.00 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	818 354	1687 768	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.17 (B) (INPUT = 0.90)
JSI METAL = 0.07 (K) (INPUT = 1.00)



Structural component only
DWG# T-2007166

DRWG NO.

Version 1.8.310 S Oct 29 2019 Milek Industrial, Inc. Sat Apr 25 13:02:30 2020 Page 1
ID:K?TPdhgJ0npl1qIYdbWIOFzIdeG-hLC0eLNpxLDcHzzhe28IBe8YnyvF9WN15r7i7zNB1N




JSI GRIP= 0.36 (H) (INPUT = 0.90)
JSI METAL= 0.13 (B) (INPUT = 1.00)



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T54S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Sat Apr 28 13:02:31 2020 Page 1
ID:K7TPdhgJOnp1qYdbWIOFzdeG-9YmOrgNRhLTv7YICleXkshknMhguyRrKVkRWZzNB1M

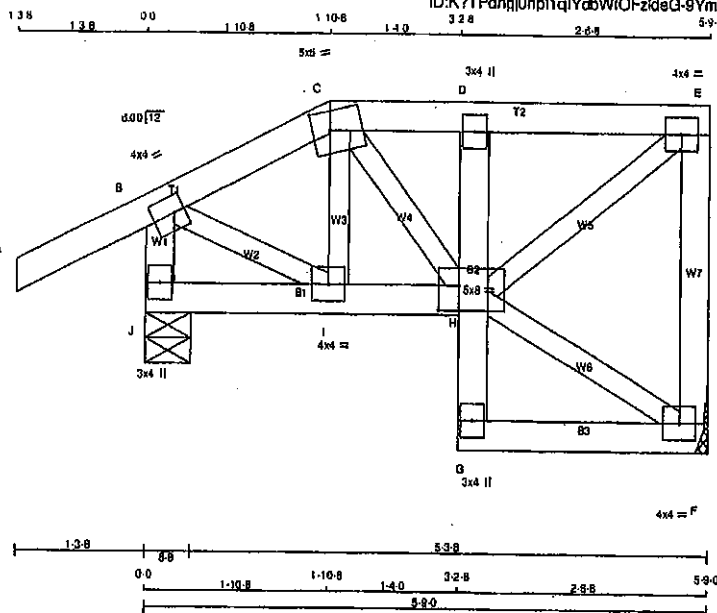

Scale = 1/21.0

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - E	2x4	DRY	No.2	SPF		
F - H	2x4	DRY	No.2	SPF		
J - B	2x4	DRY	No.2	SPF		
G - D	2x4	DRY	No.2	SPF		
G - F	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	4.0	2.00	1.25
C	TTWW-m	MT20	5.0	6.0	2.25	2.00
D	TMVW-p	MT20	3.0	4.0		
E	TMVW-t	MT20	4.0	4.0		
F	BMVW-t	MT20	4.0	4.0		
G	BMVW-p	MT20	3.0	4.0		
H	BVMWWW-t	MT20	5.0	8.0	3.00	2.50
I	BMVW-t	MT20	4.0	4.0		
J	BMVW-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
F	302	0	302	0
J	456	0	456	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
F	214	139 / 0
J	320	225 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO									
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	I-C	-50 / 10	0.01 (1)	
B-C	-240 / 0	-91.8	-91.8	0.12 (1)	8.25	C-H	0 / 84	0.02 (1)	
C-D	-248 / 0	-91.8	-91.8	0.06 (1)	6.25	H-F	-9 / 0	0.00 (1)	
D-E	-241 / 0	-91.8	-91.8	0.07 (1)	6.25	H-E	0 / 302	0.07 (1)	
F-E	-278 / 0	0.0	0.0	0.05 (1)	7.81	E-I	0 / 214	0.05 (1)	
J-B	-439 / 0	0.0	0.0	0.04 (1)	7.81				
J-I	0 / 0	-18.5	-18.5	0.02 (4)	10.00				
I-H	0 / 193	-18.5	-18.5	0.04 (1)	10.00				
G-H	0 / 25	0.0	0.0	0.02 (1)	10.00				
H-D	-219 / 0	0.0	0.0	0.01 (1)	7.81				
G-F	0 / 8	-18.5	-18.5	0.03 (4)	10.00				

TOTAL WEIGHT = 31 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2018

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2010
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.16")
CALCULATED VERT. DEFL. (LL) = L/899 (0.06")
ALLOWABLE DEFL. (TL) = L/360 (0.16")
CALCULATED VERT. DEFL. (TL) = L/999 (0.01")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (H-I:1), WB=0.07/1.00 (E-H:1), SS=0.10/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1856


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.33 (B) (INPUT = 0.90)
JSI METAL = 0.13 (B) (INPUT = 1.00)

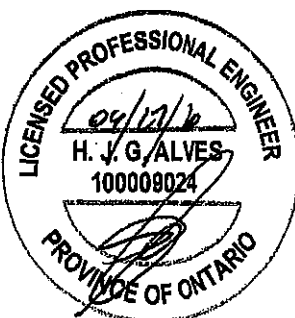


Structural component only
DWG# T-2007182

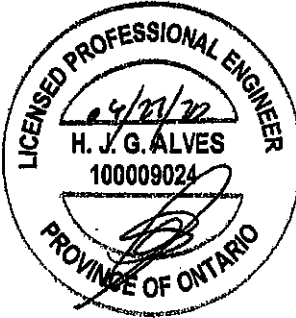JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.												
408170	T55	1	2	TRUSS DESC.														
Tamarack Roof Truss, Burlington																		
Version 8.310 8 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:32 2020 Page 2 ID:K?TPdhaiQnpl1clYdbWIOFzIdeG-dkkM30C3SzTJWH74mT9mG3DvHI 9dNX?Z9U 2?zNB1L																		
PLATES (tablets in / nohes) <table><tr><td>JT TYPE</td><td>PLATES</td><td>W</td><td>LEN</td><td>Y</td><td>X</td></tr><tr><td>F 9MV1+p</td><td>MT20</td><td>3.0</td><td>6.0</td><td></td><td></td></tr></table>							JT TYPE	PLATES	W	LEN	Y	X	F 9MV1+p	MT20	3.0	6.0		
JT TYPE	PLATES	W	LEN	Y	X													
F 9MV1+p	MT20	3.0	6.0															
 Structural component only DWG# T-2007183																		

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T56	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:33 2020 Page 1
ID:K?TPdhgi0npl1qYdbWIOFzIdaG-6wu8GMPIDGbABRIGJAg?phm499FsMnS8opDXbRzNB1K

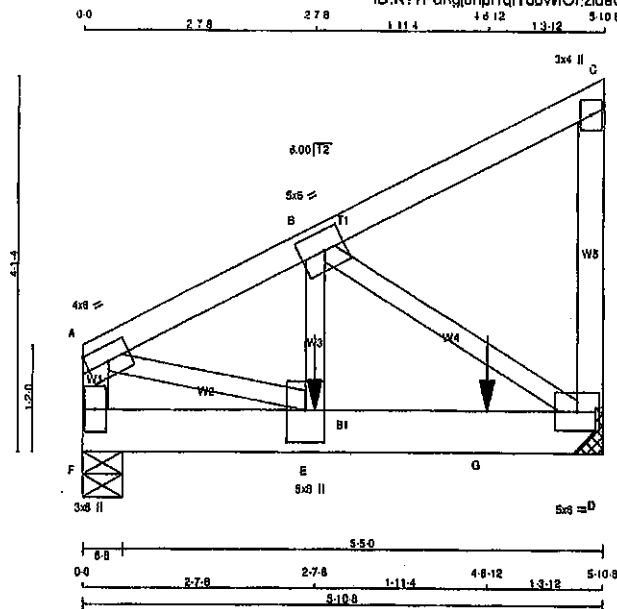

Scale = 1/2" = 1'-0"

CHORDS	SIZE	LUMBER	DESCR.
F - A	2x4	DRY No.2	SPF
A - C	2x4	DRY No.2	SPF
D - C	2x4	DRY No.2	SPF
F - D	2x6	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
DRY, SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F-A 1 12	TOP	
A-C 1 12	TOP	
C-D 1 12	TOP	
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F-D 2 5	SIDE(549.3)	
WEBS : (0.122"x3") SPIRAL NAILS		
B-E 1 2	SIDE(259.5)	
2x3 1 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	4.0	8.0		Edge
B	TMVW-1	MT20	5.0	8.0	2.50	2.75
C	TMVW-1	MT20	3.0	4.0		
D	BMVW-1	MT20	5.0	8.0		
E	BMVW-1	MT20	5.0	8.0	4.25	2.50

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
			5RG	6RG
			IN-SX	IN-SX
F	2334	0	0	5-8
D	2733	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4'-0".

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
F	1846	1103 / 0	0 / 0	0 / 0	0 / 0	543 / 0	0 / 0
D	1929	1290 / 0	0 / 0	0 / 0	0 / 0	639 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.20 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LOG1 MAX. CS (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS (LC)
FR-TO		FROM TO			FR-TO		
F-A	-2316 / 0	0.0	0.0 0.13 (1)	7.37	A-E	0 / 2896	0.36 (1)
A-B	-3101 / 0	-91.8	-91.8 0.08 (1)	5.20	E-B	0 / 2880	0.36 (1)
B-C	-5 / 0	-91.8	-91.8 0.08 (1)	10.00	B-D	-3303 / 0	0.42 (1)
D-C	-138 / 0	0.0	0.0 0.02 (1)	7.81			
F-E	0 / 0	-18.5	-18.5 0.01 (4)	10.00			
E-G	0 / 2779	-18.5	-18.5 0.57 (1)	10.00			
G-D	0 / 2779	-18.5	-18.5 0.57 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	2-7-8	-3101	-3101	---	BACK	VERT	TOTAL	---	C1
G	4-8-12	-1318	-1318	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6	PSF
DL	= 6.0	PSF
BOT CH. LL	= 0.0	PSF
DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (0.20")
CALCULATED VERT. DEFL.(LL) = 1/989 (0.02")
ALLOWABLE DEFL.(TL) = 1/360 (0.20")
CALCULATED VERT. DEFL.(TL) = 1/989 (0.04")

CSI: TO=0.13/1.00 (A-F:1), BC=0.57/1.00 (D-E:1), WB=0.42/1.00 (B-D:1), BS=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (E) (INPUT = 0.90)
JSI METAL= 0.60 (E) (INPUT = 1.00)



Structural component only
DWG# T-2007184 1/2


CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T56	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington


Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 26 13:02:33 2020 Page 2
ID:K?TPdngl0npl1qYdbWlOFzIdeG-6wu8GMPIDGbA8RIGJAg7pHm499FaMnS8opDXbRzNB1K

PLATES (table is in inches)
JT TYPE PLATES W LEN Y X
F 8MV1+p MY20 3.0 6.0
Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

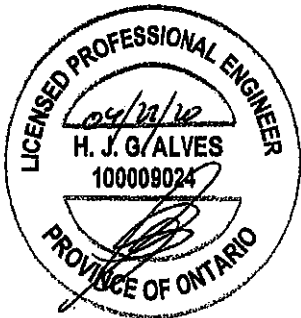

Structural component only
DWG# T-2007184 3/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	PB1	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:46 2020 Page 1					
ID:DMCubINVR6TsIFoe31v8f_zns11-PDfyPME2p5alfFmuAaG4lkD6h8P9Gw7nTyvpaZzNBRN					
Scale = 1:23.3					

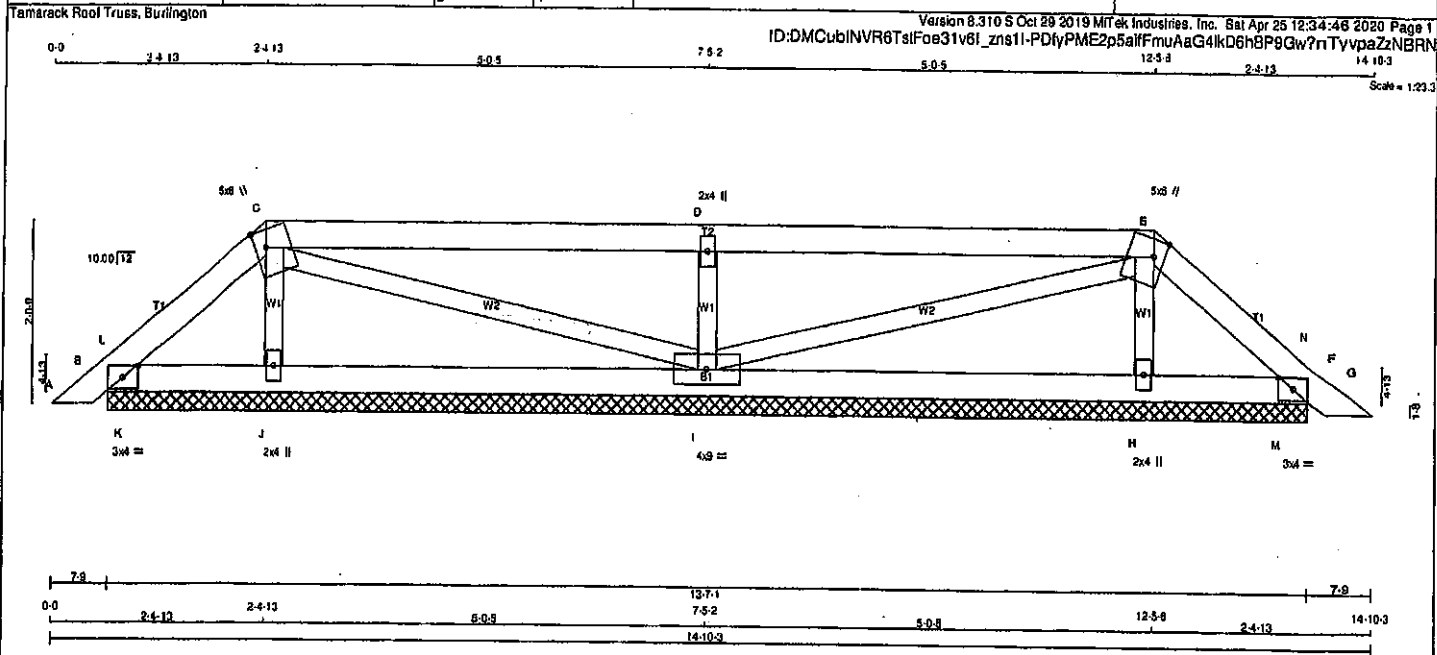

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - F	2x4	DRY	No.2
ALL WEBS 2x3 DRY			
DRY SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	3.0	4.0	1.50 2.00
C	TTWW-w	MT20	5.0	6.0	2.25 1.50
D	TTWW-w	MT20	2.0	4.0	
E	TTWW-w	MT20	5.0	6.0	2.25 1.50
F	TMB1-I	MT20	3.0	4.0	1.50 2.00
H	BMW1-w	MT20	2.0	4.0	
I	BMWW1-I	MT20	4.0	8.0	
J	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	JT	GROSS REACTION	BRG	IN-SX	BRG	IN-SX
B	169	0	169	0	0	13-7-1	13-7-1
F	169	0	169	0	0	13-7-1	13-7-1
J	288	0	288	0	0	13-7-1	13-7-1
I	683	0	683	0	0	13-7-1	13-7-1
H	288	0	288	0	0	13-7-1	13-7-1

UNFACTORED REACTIONS		1ST CASE		MAX/MIN COMPONENT REACTIONS	
JT	COMBINED	JT	COMBINED	JT	COMBINED
B	118	93/0	0/0	0/0	0/0
F	118	93/0	0/0	0/0	0/0
J	207	118/0	0/0	0/0	0/0
I	481	327/0	0/0	0/0	0/0
H	207	118/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F, J, I, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)
FR-TO		FR-TO		FR-TO		FR-TO	
A-B	0/14	FROM TO	10.00	J-C	-194/0	0.03 (1)	
B-L	-31/4	FROM TO	10.00	C-I	-22/0	0.01 (1)	
L-C	-60/0	FROM TO	10.00	I-D	-576/0	0.08 (1)	
C-D	-8/0	FROM TO	10.00	D-E	-22/0	0.01 (1)	
D-E	-8/0	FROM TO	10.00	E-H	-194/0	0.03 (1)	
E-N	-60/0	FROM TO	10.00	H-L	-121/0	0.00 (1)	
N-F	-31/4	FROM TO	10.00	L-M	-121/0	0.00 (1)	
F-G	0/14	FROM TO	10.00	M-N	-121/0	0.00 (1)	
B-K	0/42	FROM TO	10.00				
K-J	0/42	FROM TO	10.00				
J-I	0/29	FROM TO	10.00				
I-H	0/29	FROM TO	10.00				
H-M	0/42	FROM TO	10.00				
M-F	0/42	FROM TO	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

(55% OF 81.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.39/1.00 (C-D:1), BC=0.10/1.00 (H-I:4), WB=0.08/1.00 (D-I:1), SS=0.22/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRP(DRY) SHEAR SECTION (PS) (PL) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1987 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP=0.30 (D) (INPUT = 0.80)
JSI METAL=0.12 (D) (INPUT = 1.00)

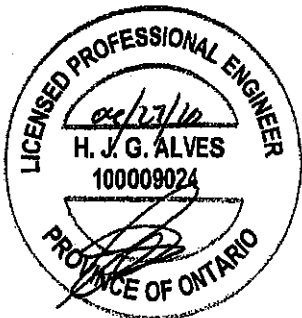

Structural component only
DWG# T-2007128

JOB NAME 408169	TRUSS NAME PB20	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MATEK Industries, Inc. Sat Apr 25 12:49:22 2020 Page 1
ID:K7TPdhg0np1qYdbWIOFzIdaG-mib6FuqXVEXPlkFUY_VFTVtTIPkW7jivF8AJozNBDh

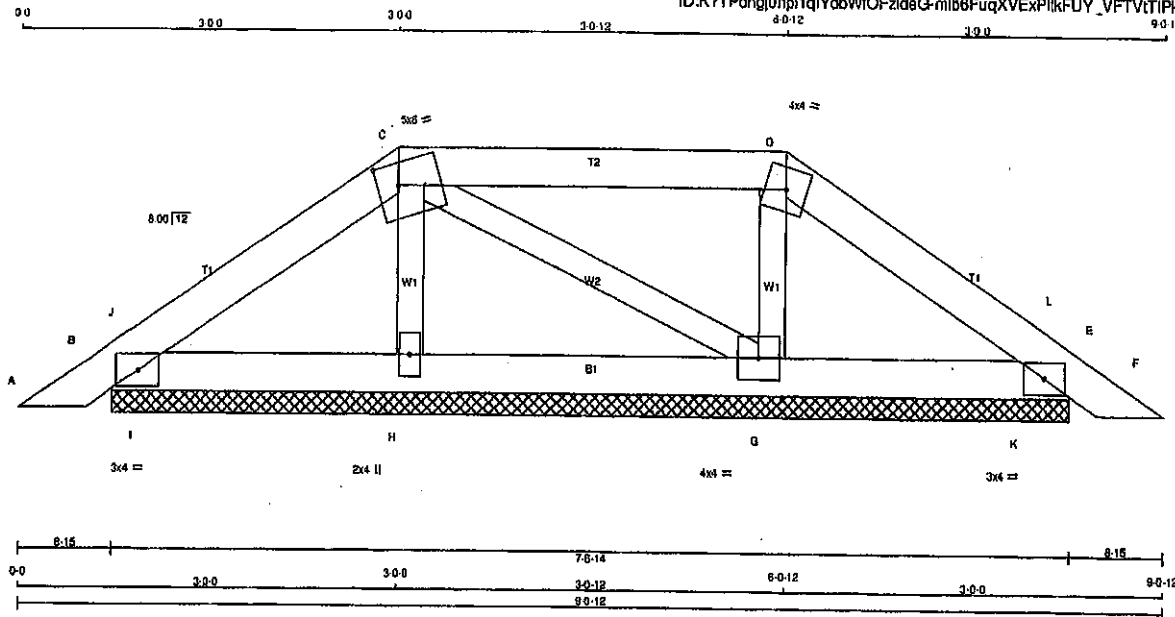

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
B - E	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0		
C	TTW-m	MT20	5.0	6.0	2.00	2.00
D	TTW-m	MT20	4.0	4.0		
E	TMB1-I	MT20	3.0	4.0		
G	BMW1-I	MT20	4.0	4.0		
H	BMW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQRD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
B	221	0	221	0	7-6-14	7-6-14
E	209	0	209	0	7-6-14	7-6-14
H	248	0	248	0	7-6-14	7-6-14
G	280	0	280	0	7-6-14	7-6-14

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX/MIN. COMPONENT REACTIONS					SOIL
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	
B	154	113 / 0	0 / 0	0 / 0	0 / 0	41 / 0	0 / 0
E	148	108 / 0	0 / 0	0 / 0	0 / 0	39 / 0	0 / 0
H	178	109 / 0	0 / 0	0 / 0	0 / 0	87 / 0	0 / 0
G	198	127 / 0	0 / 0	0 / 0	0 / 0	71 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 15	-91.8	-91.8 0.03 (1)	10.00	H-C	-176 / 0	0.03 (1)
B-J	-83 / 0	-91.8	-91.8 0.01 (1)	8.25	C-G	-21 / 0	0.00 (1)
J-C	-74 / 0	-91.8	-91.8 0.05 (1)	8.25	G-D	-188 / 0	0.03 (1)
C-D	-30 / 0	-91.8	-91.8 0.15 (1)	8.25	I-J	-121 / 0	0.00 (1)
D-L	-54 / 0	-91.8	-91.8 0.05 (1)	8.25	K-L	-123 / 0	0.00 (1)
L-E	-41 / 0	-91.8	-91.8 0.01 (1)	8.25			
E-F	0 / 15	-91.8	-91.8 0.03 (1)	10.00			
B-I	0 / 60	-18.5	-18.5 0.08 (1)	10.00			
J-H	0 / 80	-18.5	-18.5 0.08 (1)	10.00			
H-G	0 / 48	-18.5	-18.5 0.03 (1)	10.00			
G-K	0 / 43	-18.5	-18.5 0.08 (1)	10.00			
K-E	0 / 43	-18.5	-18.5 0.08 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 6.0 PSF

BOT CH. LL = 0.0 PSF
DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.15/1.00 (C-D:1), BC=0.08/1.00 (B-I:1), WB=0.03/1.00 (D-G:1), SSI=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)


MAX MIN MAX MIN MAX MIN

MT20 618 384 1687 788 1887 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.18 (B) (INPUT = 0.90)
JSI METAL = 0.04 (B) (INPUT = 1.00)

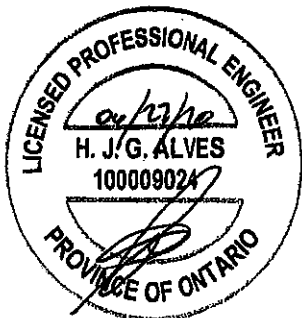

Structural component only
DWG# T-2007144

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	J1	19	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 6.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:43 2020 Page 1					
ID:DMCubINVr6TstFoe31v6l_zns11-7a_pnKBWAC7001JURIN76ba9zNy3aYKn_h8zEzNBRC					
Scale = 1:22.5					

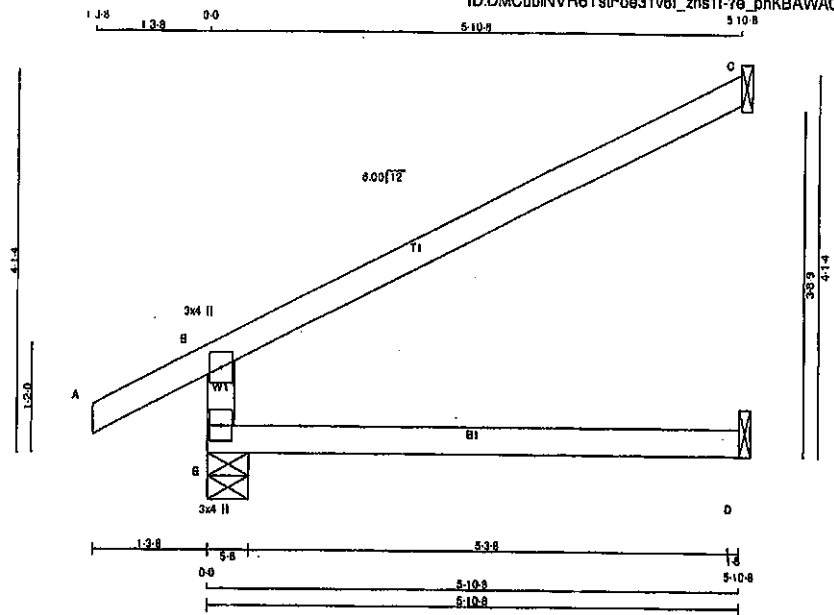

TOTAL WEIGHT = 19 X 17 = 319 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2		
A - C	2x4	DRY	No.2		
E - D	2x4	DRY	No.2		

DRY: SEASONED LUMBER.

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0		
E	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
JT	VERT	HORZ	DOWN	UP
E	625	0	525	0
C	202	0	202	0
D	45	0	50	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOSE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	389	287/0	0/0	0/0	0/0	111/0	0/0
C	139	113/0	0/0	0/0	0/0	28/0	0/0
D	38	0/0	0/0	0/0	0/0	38/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 0.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED
MEMB.	FORCE	(PLF)	(LBS)	CSI (LC)	UNBRAC	LENGTH	FR-TO	FORCE
FR-TO		FROM	TO					
E-B	-461/0	0.0	0.0	0.13 (4)	7.81			
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00			
B-C	-30/0	-91.8	-91.8	0.54 (1)	8.25			
E-D	0/0	-18.5	-18.5	0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (N/A:0), SSI=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.19 (E) (INPUT = 0.90)
JSI METAL= 0.13 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007126

JOB NAME 408168	TRUSS NAME J2	QUANTITY 8	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:44 2020 Page 1
ID:DMCubINVR6T8iF0831v61_zns1i-TRYB_gCoHTK_Pxv29DcgJ8qrNjco1oU?eQjVhzNBRP

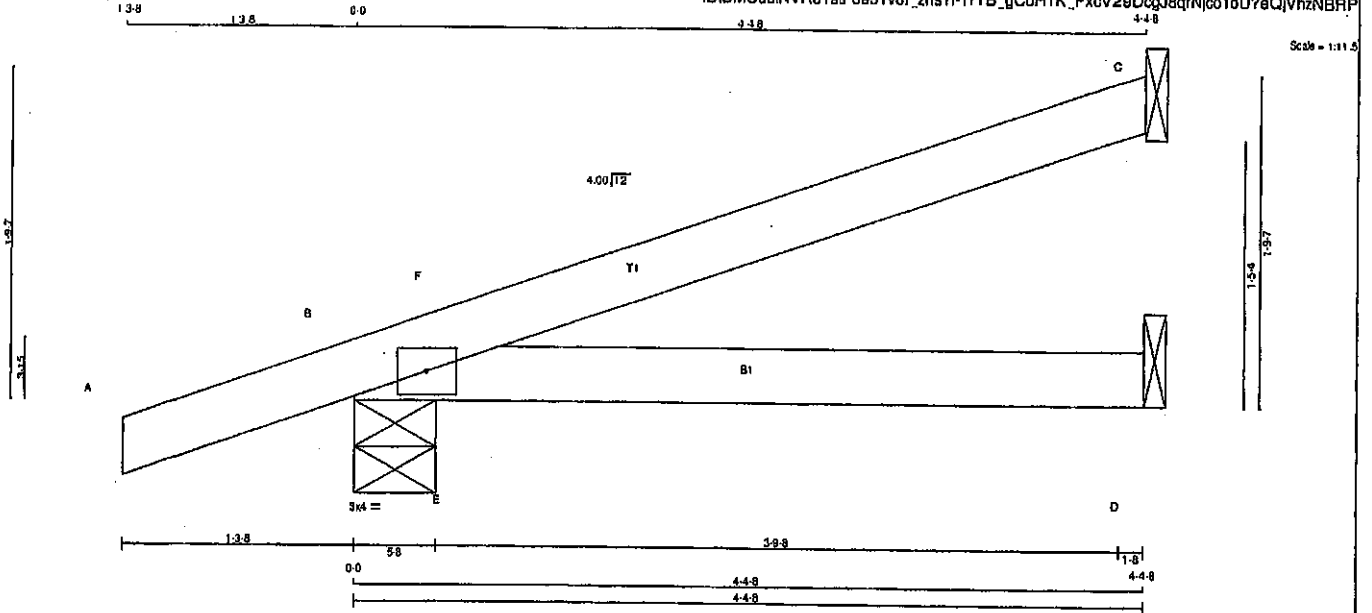

Scale = 1:11.5

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. LUMBER DESCR. SPF SPF DRY: SEASONED LUMBER. TOTAL WEIGHT = 8 X 12 = 95 lb

CHORDS	SIZE	LUMBER	DESCR.	SPF
A - C	2x4	DRY	No.2	SPF
B - D	2x4	DRY	No.2	SPF

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B TMB1-1	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER:

BEARINGS							
	FACTORED		MAXIMUM FACTORED		INPUT	REQD	
	GROSS REACTION		GROSS REACTION		BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
C	174	0	174	0	0	1-8	1-8
B	384	0	384	0	0	5-8	5-8
D	68	0	68	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL 897781H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
	1ST CASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SC
C	120	93/0	0/0	0/0	0/0	27/0	0/0
B	255	180/0	0/0	0/0	0/0	75/0	0/0
D	50	19/0	0/0	0/0	0/0	32/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 18	-91.8	-91.8	0.11 (1)	10.00	E-F	-194 / 7
B-F	-14 / 0	-91.8	-91.8	0.05 (4)	8.25		
F-C	0 / 2	-91.8	-91.8	0.22 (1)	10.00		
B-E	0 / 0	-18.5	-18.5	0.17 (1)	10.00		
E-D	0 / 0	-18.5	-18.5	0.17 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2015, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.18')
CALCULATED VERT. DEFL.(LL) = $L/889$ (0.02')
ALLOWABLE DEFL.(TL) = $L/360$ (0.18')
CALCULATED VERT. DEFL.(TL) = $L/889$ (0.05')

CSI: TC=0.22/1.00 (C-F:1), BC=0.17/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SS=0.18/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 768 1987 1658

PLATE PLACEMENT TOL. = 0.260 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (B) (INPUT = 0.80)
JSI METAL = 0.07 (B) (INPUT = 1.00)

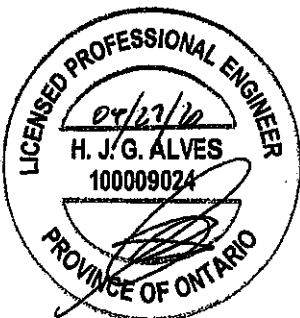

Structural component only
DWG# T-2007127

JOB NAME

408169

TRUSS NAME

J20S

QUANTITY

3

PLY

1

JOB DESC.

GREEN PARK HOMES

DRWG NO.

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:49:21 2020 Page 1

ID:K7TPdhgJ0npl1qYdbWfOFzIdeG-I2k2YpvkxPY7j92wrSGiGzIsV3rmg3ZgbMdnLzNBD

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
H - B	2x4	DRY	No. 2	SPF	
A - D	2x4	DRY	No. 2	SPF	
H - G	2x4	DRY	No. 2	SPF	
F - C	2x4	DRY	No. 2	SPF	
F - E	2x4	DRY	No. 2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No. 2	SPF	
E - D	2x4	DRY	No. 2	SPF	

DRY; SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TMV+p	MT20	3.0	4.0		
D	TMWW-I	MT20	5.0	8.0	2.50	2.50
E	BMWW-I	MT20	4.0	4.0		
F	BMV+p	MT20	3.0	4.0		
G	BMWW-I	MT20	5.0	8.0	3.00	2.50
H	BMV-I+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
H	332	0	332	0	0	5-8	5-8
E	208	0	208	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	232	168 / 0	0 / 0	0 / 0	0 / 0	66 / 0	0 / 0
E	145	95 / 0	0 / 0	0 / 0	0 / 0	50 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (8)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
H-B	-307 / 0	0.0	0.0 (0.03 (1))	7.81	B-G	0 / 83	0.02 (1)
A-B	0 / 35	-91.8	-91.8 (0.14 (5))	10.00	E-D	-184 / 0	0.05 (1)
B-C	-83 / 0	-91.8	-91.8 (0.07 (1))	6.25	G-E	-14 / 0	0.00 (1)
C-D	-100 / 0	-91.8	-91.8 (0.08 (1))	6.25	G-D	0 / 220	0.05 (1)
H-G	0 / 0	-18.5	-18.5 (0.04 (4))	10.00			
F-G	0 / 12	0.0	0.0 (0.02 (1))	10.00			
G-C	-218 / 0	0.0	0.0 (0.02 (1))	7.81			
F-E	0 / 9	-18.5	-18.5 (0.01 (4))	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 29 = 86 LB

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
DL =	6.0	PSF
BOT CH.	LL = 0.0	PSF
DL =	7.4	PSF
TOTAL LOAD =	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19')

CALCULATED VERT. DEFL.(LL) = L/999 (0.00')

ALLOWABLE DEFL.(TL) = L/360 (0.19')

CALCULATED VERT. DEFL.(TL) = L/999 (0.00')

CSI: TC=0.14/1.00 (A-B-S), BC=0.04/1.00 (G-H-I), WB=0.05/1.00 (D-E-I), SSI=0.09/1.00 (A-B-S)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PS)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.90)

JSI METAL = 0.07 (C) (INPUT = 1.00)

LICENSED PROFESSIONAL ENGINEER

04/27/20

H. J. G. ALVES

100009024

PROVINCE OF ONTARIO

Structural component only

DWG# T-2007143

JOB NAME
048170

TRUSS NAME
J40

QUANTITY
1

PLY
1

JOB DESC.
GREEN PARK HOMES

TRAUSS DESC.

DRWG NO.

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:14 2020 Page 1

ID:K?TPdhqj0np1qYdbWIOFzIdaG-9GFyHsAnIRCMwcihqYYGUjuVsSPHGLOM61Q2zNB1c

Scale = 1/2" = 1'-0"

LUMBER
N.L.G.A. RULES
CHORDS SIZE LUMBER DESCH.
F - B 2x4 DRY No.2 SPF
A - C 2x4 DRY No.2 SPF
F - D 2x4 DRY No.2 SPF
ALL WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.

PLATES (table is in inches)
JT TYPE PLATES W LEN Y X
B TMVW+ MT20 4.0 4.0 2.00 1.25
E BMW+w MT20 2.0 4.0
F BMV1+p MT20 3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
FACTORED MAXIMUM FACTORED INPUT REORO
GROSS REACTION GROSS REACTION BRG BRG
JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX
F 441 0 441 0 0 5-8 5-8
C 284 0 284 0 0 1-8 1-8
D 53 0 60 0 0 1-8 1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS
1ST LOASE MAX/MIN COMPONENT REACTIONS
JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL
F 310 217 / 0 0 / 0 0 / 0 0 / 0 93 / 0 0 / 0
C 182 147 / 0 0 / 0 0 / 0 0 / 0 35 / 0 0 / 0
D 43 0 / 0 0 / 0 0 / 0 0 / 0 43 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS FACTORED WEBBS
MEMB. MAX. FORCE VERT. LOAD LC1 MAX. CS1(LC) UNBRAC LENGTH FR-TO MEMB. MAX. FORCE MAX. CS1(LC)
FR-TO FROM TO 0.0 0.0 0.05 (1) 7.81 B-E 0 / 0 0.00 (1)
F-B -388 / 0 0.0 -91.8 0.12 (1) 10.00
A-B 0 / 28 -91.8 -91.8 0.52 (1) 10.00
B-C 0 / 0 -91.8 -91.8 0.52 (1) 10.00
F-E 0 / 0 -18.5 -18.5 0.14 (4) 10.00
E-D 0 / 0 -18.5 -18.5 0.18 (4) 10.00

TOTAL WEIGHT = 20 b

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBCO 2018 , CBCO 2012 , ABC 2019
- PART 9 OF CBCO 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(58 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/898 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/898 (0.05")

CSI: TC=0.52/1.00 (B-C:1) , BC=0.18/1.00 (D-E:4) , WB=0.00/1.00 (B-E:1) , SSI=0.18/1.00 (B-C:1)

DOI LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1897 788 1897 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.24 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)

LICENSED PROFESSIONAL ENGINEER
04/29/20
H. J/G. ALVES
100009024
PROVINCE OF ONTARIO

Structural component only
DWG# T-2007167

JOB NAME

TRUSS NAME

QUANTITY

PLY

JOB DESC.

GREEN PARK HOMES

DRWG NO.

408170

C40

3

1

TRUSS DESC.

Tamarack Roof Truss, Burlington

Version 6.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:08 2020 Page 1

ID:K?TPdngj0npl1qiYdbWfOFzIdeG-K7htp608bSjebtMQj8l?Emz4pp?ZnT2QjCoZNB1

13.8

13.8

0.0

39.7

21.1

510.8

Scale = 1:17.9

600/T2

3x4 II

B

A

WT

E

3x4 II

0

13.8

5.8

32.7

1.0

111.8

510.8

32.7

510.8

LUMBER

N. L. G. A. RULES

CHORDS SIZE

E - B 2x4 DRY No.2

A - C 2x4 DRY No.2

E - D 2x4 DRY No.2

DESCR.

SPF

SPF

SPF

DRY; SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE PLATES W LEN Y X

B TMV+ep MT20 3.0 4.0

E BMV1+ep MT20 3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED MAXIMUM FACTORED INPUT RECORD

GROSS REACTION GROSS REACTION BRG BRG

JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX

E 405 0 405 0 0 5-8 5-8

C 130 0 130 0 0 1-8 1-8

D 45 0 50 0 0 1-8 1-8

SEE MITEK STANDARD DETAIL B87781H FOR CONNECTION TO JOINT(S) C , D

UNFACTORED REACTIONS

1ST LCASE MAX/MIN COMPONENT REACTIONS

JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL

E 288 190 / 0 0 / 0 0 / 0 98 / 0 0 / 0

C 90 73 / 0 0 / 0 0 / 0 0 / 0 17 / 0 0 / 0

D 36 0 / 0 0 / 0 0 / 0 0 / 0 36 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E , C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS WEBS

MEMB. MAX. FACTORED FORCE VERT. LOAD LG1 MAX CSI (LC) UNBRAC LENGTH FR-TO MEMB. MAX. FACTORED FORCE MAX CSI (LG)

FR-TO FROM TO

E-B -342 / 0 0.0 0.0 0.13 (4) 7.81

A-B 0 / 28 -91.8 -91.8 0.12 (1) 10.00

B-C -19 / 0 -91.8 -91.8 0.22 (1) 6.25

E-D 0 / 0 -18.5 -18.5 0.13 (4) 10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018 , CBC 2012 , ABC 2019

- PART 9 OF CBC 2012 (2019 AMENDMENT)

- CSA 088-09, CSA 088-14

- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")

CALCULATED VERT. DEFL.(LL) = 1/999 (0.00")

ALLOWABLE DEFL.(TL)= L/360 (0.20")

CALCULATED VERT. DEFL.(TL) = 1/999 (0.03")

CSI: TG=0.22/1.00 (B-C:1) , BC=0.13/1.00 (D-E:4) , WS=0.00/1.00 (1/3:0) , SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (E) (INPUT = 0.80)

JSI METAL= 0.09 (B) (INPUT = 1.00)

LICENSED PROFESSIONAL ENGINEER

04/22/12

H. J. G. ALVES


100009024

PROVINCE OF ONTARIO

Structural component only

DWG# T-2007162

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	C41	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 8 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:09 2020 Page 1					
ID:K7TPdhgJ0np1q1YdbWIOFzIdeG-pJR3E96etvaaG3llw7ENrDmzlU9yk01cG4PGkrzNB1i					
5-10-8					

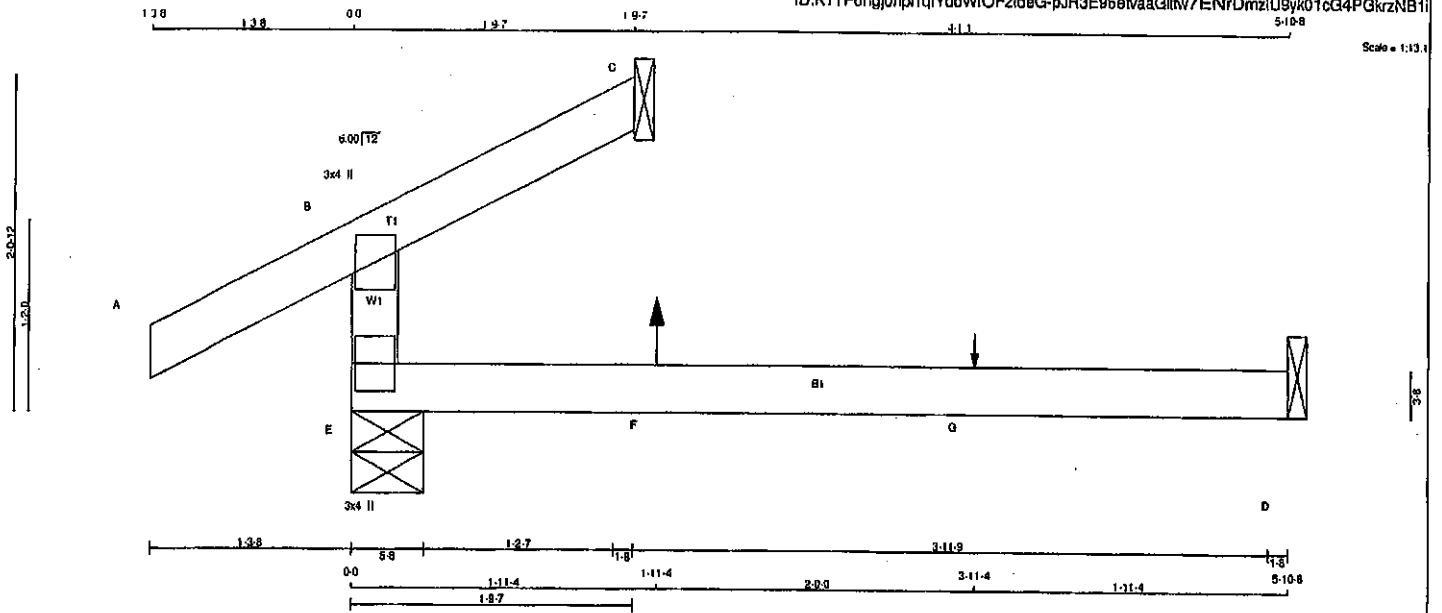

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	NUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMV+p	MT20	3.0	4.0	
E BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	VERT	HORZ	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
			DOWN	HORZ	DOWN	HORZ		
E	284	0	284	0	0	0	5-8	5-8
C	83	0	83	0	0	0	1-8	1-8
D	44	0	52	0	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

JT	COMBINED	MAX/MIN. COMPONENT REACTIONS						
		1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	200	137/0	0/0	0/0	0/0	0/0	62/0	0/0
C	48	21/0	0/0	0/0	0/0	0/0	25/0	0/0
D	35	0/-3	0/0	0/0	0/0	0/0	37/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (7)

MEMB.	MAX. FACTORED FORCE (LBS)	CHORDS				MEMB.	MAX. FACTORED FORCE (LBS)	WEBS	
		VERT. LOAD	LC1	MAX	MAX			MAX. FACTORED FORCE (LBS)	MAX
FR-TO		FROM	TO	LENGTH	FR-TO				
E-B	-227/0	0.0	0.0	0.11 (4)	7.81				
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00				
B-C	-9/9	-91.8	-91.8	0.08 (4)	10.00				
E-F	0/0	-18.5	-18.5	0.14 (4)	10.00				
F-G	0/0	-18.5	-18.5	0.14 (4)	10.00				
G-D	0/0	-18.5	-18.5	0.14 (4)	10.00				

JT	LOC.	FACTORED CONCENTRATED LOADS (LBS)		FACE	DIR.	TYPE	HEEL	CONN.
		LC1	MAX					
F	1-11-4	7	12	BACK	VERT	TOTAL	--	C1
G	3-11-4	1	1	BACK	VERT	TOTAL	--	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
LL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/G

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIG 2011, TPIG 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 615 354 1887 788 1987 1655

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.66 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007163

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	C42	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:10 2020 Page 1
ID:K7TPdngl0npl1qYdbWIOFzIdG-HV7SRV7GScIRuvRrTricNQJ6SuW4TTHmV8pHHzNB1h

Scale = 1:10.2

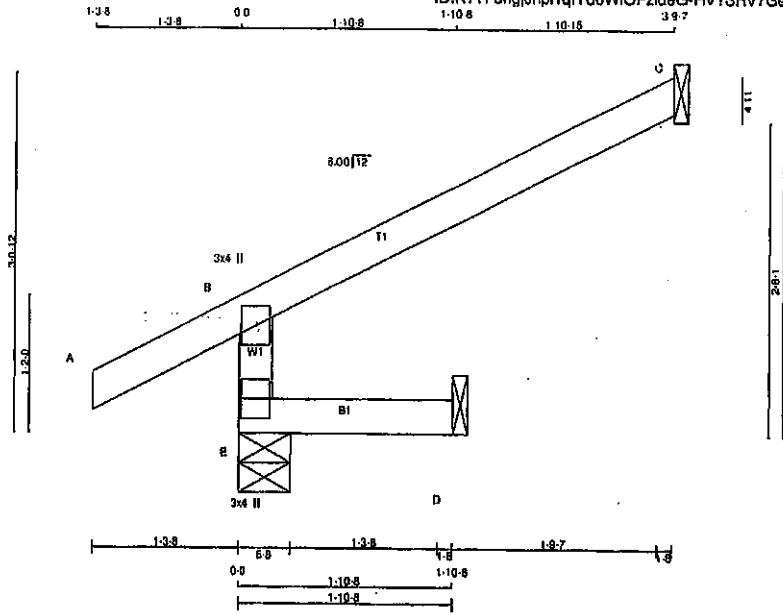

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y
B TMV+p	MT20	3.0	4.0	
E BMV+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	JT	GROSS REACTION	BRG	BRG	BRG	BRG
E	381	0	381	0	0	5-8	5-8
C	130	0	130	0	0	1-8	1-8
D	18	0	17	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		MAX./MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE
E	250	190/0	0/0
C	80	73/0	0/0
D	12	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (6)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. FACTORED (LBS)	MEMB.	FORCE (LBS)
FR-TO				FR-TO	
E-B	-342/0	0.0	0.0	0.01 (4)	7.81
A-B	0/28	-91.8	-91.8	0.13 (5)	10.00
B-C	-19/0	-91.8	-91.8	0.22 (1)	6.25
E-D	0/0	-18.5	-18.5	0.02 (4)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 10 = 29 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCG 2010, NBCG 2015, ABO 2019
- PART 9 OF NBCG 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/989$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/989$ (0.00")

CSK: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SBI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.14 (E) (INPUT = 0.80)
JSI METAL=0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007164

JOB NAME

408170

TRUSS NAME

C43

QUANTITY

3

PLY

1

JOB DESC.

GREEN PARK HOMES

DRWG NO.

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 MiTek Industries, Inc. Sat Apr 25 13:02:11 2020 Page 1

ID:K?TPchgi0npl1q1YdbWIOFzIdeG-1lZq1r8uPWq1V2011YHrwasJqls_CwXvkOuNqzN1B1g

Scale = 1:12.1

LUMBER

N. L. G. A. RULES

CHORDS

SIZE

DRY

LUMBER

No.2

E - B

2x4

DRY

No.2

A - C

2x4

DRY

No.2

E - D

2x4

DRY

No.2

DRY: SEASONED LUMBER.

PLATES (Labels in inches)

JT TYPE

PLATES

W

LEN

Y

X

B

TMV+p

MT20

3.0

4.0

E

BMV1+p

MT20

3.0

4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED

GROSS REACTION

MAXIMUM FACTORED

GROSS REACTION

INPUT

BRG

REORD

BRG

JT

VERT

HORZ

DOWN

HORZ

UPLIFT

IN-SX

IN-SX

E

271

0

271

0

0

5-8

5-8

C

45

0

45

0

23

1-8

1-8

D

8

0

17

0

2

1-8

1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

1ST LOASE

MAX./MIN. COMPONENT REACTIONS

JT

COMBINED

SNOW

LIVE

PERM.LIVE

WIND

DEAD

SOIL

E

188

141/0

0/0

0/0

0/0

47/0

0/0

C

31

24/-18

0/0

0/0

0/0

7/0

0/0

D

7

0/-8

0/0

0/0

0/0

12/0

0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS

MAX. FACTORED

FACTORED

VERT. LOAD

LC1

MAX

MEMB.

FORCE

MAX

FACTORED

MEMB.

FORCE

VERT. LOAD

LC1

MAX

MEMB.

FORCE

MAX

FACTORED

FR-TO

FROM

TO

LENGTH

FR-TO

E-B

-244/0

0.0

0.0

0.04 (5)

7.81

A-B

0/28

-91.8

-91.8

0.12 (1)

10.00

B-C

-17/0

-91.8

-91.8

0.09 (1)

6.25

E-D

0/0

-18.5

-18.5

0.04 (5)

10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BOC 2018, OBC 2012, ABC 2019

- PART 9 OF OBC 2012 (2019 AMENDMENT)

- CSA 088-08, CSA 088-14

- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")

CALCULATED VERT. DEFL.(LL) = L/999 (0.00")

ALLOWABLE DEFL.(TL) = L/360 (0.19")

CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5), WB=0.08/1.00 (n/a:0), SSI=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 818 354 1667 788 1987 1868

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT= 0.80)

JSI METAL= 0.07 (B) (INPUT= 1.00)

LICENSED PROFESSIONAL ENGINEER

04/12/20

H. J.G. ALVES

100009024

PROVINCE OF ONTARIO

Structural component only

DWG# T-2007165

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.


Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options Information on p. 126.

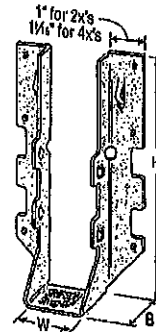


LUS28




LU28L



HUS210
(HUS26, HUS28,
and HHUS similar)



HGUS28-2



HHUS210-2



Double-Shear
Nailing
Top View





Double-Shear
Nailing
Side View;
Do not
bend tab



Dome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,560

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

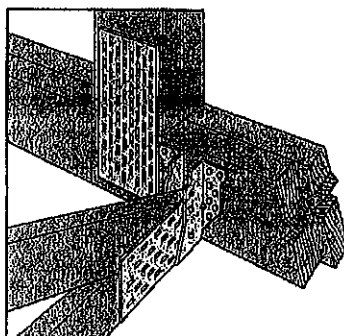

LJS26DS

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value

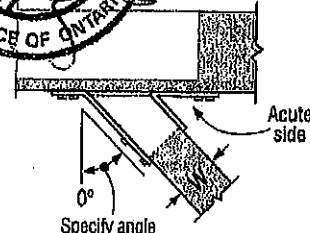

Top View HHUS Hanger
Skewed Right
(joist must be bevel cut)
All joist nails installed on the
outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ¹	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb.	(K _D = 1.00) lb.	(K _D = 1.15) lb.	(K _D = 1.00) lb.
								kN	kN	kN	kN
Single 2x Sizes											
LUS24	18	1 1/8	3 1/4	1 1/4	2 1/4	(4) 10d	(2) 10d	710	1625	645	1155
								3.16	7.23	2.87	5.14
LU24L	22	1 1/8	3	1 1/4	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360	1020	320	725
								1.60	4.54	1.42	3.22
LU26L	22	1 1/8	5	1 1/4	4 3/8	(6) 10d	(4) 10d x 1 1/2"	720	1605	645	1140
								3.20	7.14	2.87	5.07
LUS26	18	1 1/8	4 3/4	1 1/4	3 3/4	(4) 10d	(4) 10d	1420	2170	1290	1630
								6.32	9.65	5.74	7.25
HUS26	16	1 1/8	5 3/4	3	3 3/8	(14) 16d	(6) 16d	2705	4940	2065	3875
								11.80	21.97	9.20	17.24
LJS26DS	18	1 1/8	5	3 1/2	4 3/8	(16) 16d	(6) 16d	2055	4265	1460	4115
								9.14	18.97	6.49	18.31
HGUS26	12	1 1/8	5 3/4	5	4 3/8	(20) 16d	(8) 16d	2685	6625	2685	5700
								11.98	29.51	11.98	25.35
LU28L	20	1 1/8	6 3/4	1 1/4	5 3/8	(8) 10d	(6) 10d x 1 1/2"	1140	2185	1020	1550
								5.07	9.72	4.54	6.89
LUS28	18	1 1/8	6 3/4	1 1/4	3 3/4	(8) 10d	(4) 10d	1420	2620	1290	1790
								6.32	11.21	5.74	7.96
HUS28	16	1 1/8	7 3/4	3	6 3/8	(22) 16d	(8) 16d	3805	5365	2675	4345
								16.94	23.88	11.90	19.33
HGUS28	12	1 1/8	7 3/4	5	6 3/8	(36) 16d	(12) 16d	3310	7675	3310	6900
								14.74	34.19	14.74	30.73
LU210L	20	1 1/8	8	1 1/4	7 3/8	(10) 10d	(6) 10d x 1 1/2"	1140	2495	1020	1770
								5.07	11.10	4.64	7.87
LUS210	18	1 1/8	7 1/2	1 1/4	3 3/4	(8) 10d	(4) 10d	1420	2785	1290	2210
								6.32	12.39	5.74	9.83


1. Factored uplift resistances have been increased 16% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance					
		W	H	B	d _s ¹	Header	Joist	D.Fir-L		S-P-F			
								Uplift	Normal	Uplift	Normal		
								(K _G = 1.15) lb.	(K _G = 1.00) lb.	(K _G = 1.15) lb.	(K _G = 1.00) lb.		
										kN	kN	kN	kN
Double 2x Sizes													
LUS24-2	18	3 1/8	3 1/8	2	1 1/2	(4) 16d	(2) 16d	835	2020	580	1435		
SS LUS26-2	18	3 1/8	4 1/8	2	4	(4) 16d	(4) 16d	3.71	8.99	2.62	6.38		
								1720	2595	1545	1920		
HHUS26-2	14	3 1/8	5 1/8	3	3 3/8	(14) 16d	(6) 16d	7.65	11.54	6.87	8.64		
								2850	7335	2065	5205		
HGUS26-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	12.68	32.83	9.20	23.15		
								4385	8950	3110	6355		
SS LUS28-2	18	3 1/8	7	2	4	(8) 16d	(4) 16d	19.51	39.81	13.83	28.27		
								1720	3325	1545	2675		
HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	7.65	14.79	6.87	11.45		
								3765	8940	2675	6345		
HGUS28-2	12	3 1/8	7 1/8	4	8 1/8	(36) 16d	(12) 16d	16.75	39.77	11.90	28.22		
								6070	12980	4310	9215		
SS LUS210-2	18	3 1/8	9	2	8	(8) 16d	(6) 16d	27.00	57.74	19.17	40.99		
								2580	4500	2320	3195		
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d	11.48	20.02	10.32	14.21		
								4670	9600	4235	7000		
HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(48) 16d	(16) 16d	20.77	42.97	18.84	31.14		
								6840	14015	4855	10270		
								30.43	62.34	21.80	45.69		
Triple 2x Sizes													
HGUS26-3	12	4 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355		
								19.51	39.81	13.83	28.27		
HGUS28-3	12	4 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215		
								27.00	57.74	19.17	40.99		
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	4670	9670	4235	6865		
								20.77	43.02	18.84	30.54		
HGUS210-3	12	4 1/8	9 1/8	4	8 1/8	(48) 16d	(16) 16d	6840	14645	4855	10400		
								30.43	65.14	21.80	46.28		
Quadruple 2x Sizes													
HGUS28-4	12	6 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355		
								19.51	39.81	13.83	28.27		
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215		
								27.00	57.74	19.17	40.99		
HHUS210-4	14	6 1/8	8 1/8	3	7 1/8	(30) 16d	(10) 16d	4670	10155	4235	7210		
								20.77	45.17	18.84	32.07		
HGUS210-4	12	6 1/8	9 1/8	4	8 1/8	(48) 16d	(16) 16d	6840	14645	4855	10400		
								30.43	65.14	21.80	46.28		
HGUS212-4	12	6 1/8	10 1/8	4	10 1/8	(58) 16d	(20) 16d	7640	14995	5425	10845		
								33.98	66.70	24.13	47.35		
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645		
								45.08	72.95	32.00	51.80		
4x Sizes													
LUS46	18	3 1/8	4 1/8	2	3 1/8	(4) 16d	(4) 16d	1720	2595	1545	1920		
								7.65	11.54	6.87	8.64		
HHUS46	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	2650	7335	2065	5205		
								11.30	32.63	9.20	23.15		
HGUS46	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355		
								19.51	39.81	13.83	28.27		
LUS48	18	3 1/8	6 1/8	2	3 1/8	(6) 16d	(4) 16d	1720	3325	1545	2675		
								7.65	14.79	6.87	11.45		
HHUS48	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765	8940	2675	6345		
								16.75	39.77	11.90	28.22		
HGUS48	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215		
								27.00	57.74	19.17	40.99		
LUS410	18	3 1/8	8 1/8	2	5 1/8	(8) 16d	(6) 16d	2580	4500	2320	3195		
								11.48	20.02	10.32	14.21		
HGUS410	12	3 1/8	9	4	8 1/8	(48) 16d	(16) 16d	6840	14015	4855	10270		
								30.43	62.34	21.80	45.69		
HGUS412	12	3 1/8	10 1/8	4	10 1/8	(58) 16d	(20) 16d	7640	14995	5425	10845		
								33.98	66.70	24.13	47.35		
HGUS414	12	3 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645		
								45.08	72.95	32.00	51.80		



Plated Truss Connectors

See footnotes on p. 258.

TC – Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1¼". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1½" = 0.148" dia. x 1½" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

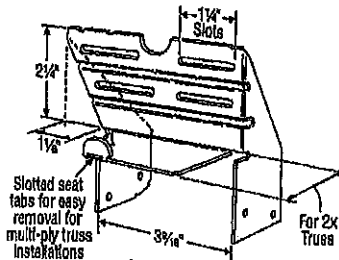


TC24
U.S. Patent 4,992,173

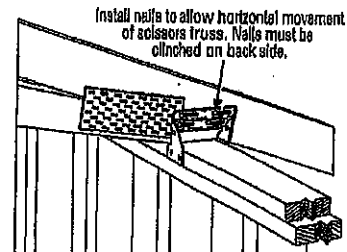


Typical TC24 Installation

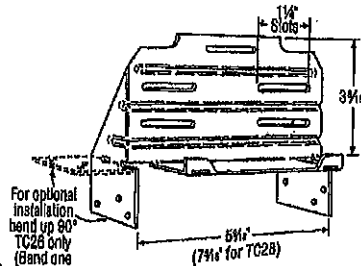

TC26
(TC28 Similar)

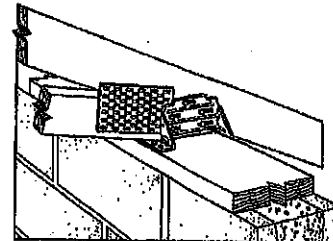

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer (8", 10", 12" Wall Installation Similar)

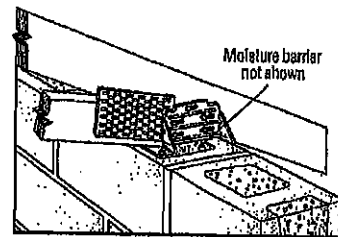

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L Uplift (K _o =1.15)	S-P-F Uplift (K _o =1.15)
			lb.	lb.
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L Uplift (K _o =1.15)	S-P-F Uplift (K _o =1.15)
			lb.	lb.
TC26	(5) 10d	(6) 10d x 1½"	810	660
	(5) 10d	(6) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.
4. TC26 fastened to grouted concrete block with (6) - ½" x 2¼" Titen screws has a factored uplift resistance of 275 lb.



(800) 999-5099
strongtie.com

H/TSP

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_F = 1.15$)					
					D.Fir-L			S-P-F		
		To Rafters/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(8) 8d x 1 1/2"	(4) 8d	—	740	685	300	680	485	215
					9.29	3.05	1.33	3.02	2.16	0.98
SS H2A	18	(5) 8d x 1 1/2"	(2) 8d x 1 1/2"	(5) 8d x 1 1/2"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	180
					3.68	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	180	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	285	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8	18	(6) 10d x 1 1/2"	(5) 10d x 1 1/2"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A	18	(9) 10d x 1 1/2"	(9) 10d x 1 1/2"	—	1735	795	410	1605	565	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1 1/2"	(9) 10d x 1 1/2"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.64	1.36
H10A-2	18	(9) 10d x 1 1/2"	(9) 10d x 1 1/2"	—	1835	1275	430	1845	880	305
					8.18	5.67	1.91	7.32	3.91	1.36
H10S ^a	18	(8) 8d x 1 1/2"	(8) 8d x 1 1/2"	(8) 8d	1485	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2 1/4"	(6) 16d x 2 1/4"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1 1/2"	(13) 8d	—	2390	855	320	1805	610	230
		[2] (12) 8d x 1 1/2"	(16) 8d	—	10.63	3.80	1.42	8.03	2.71	1.02
TSP	16	(9) 10d x 1 1/2"	(6) 10d x 1 1/2"	—	1295	440	—	920	310	—
		(9) 10d x 1 1/2"	(6) 10d	—	5.76	1.98	—	4.09	1.38	—
		(9) 10d x 1 1/2"	(6) 10d	—	1860	440	—	1105	310	—
					8.94	1.96	—	4.92	1.38	—

- Factored resistances have been increased 16% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2 1/2" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 695 lb. (2.85 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.61 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (6) 8d x 1 1/2" nails into the top plates and (3) 8d x 1 1/2" nails into the lowest three flange holes into the truss bottom chord is 485 lb. (2.20 kN).
- Nails: 16d x 2 1/4" = 0.182" dia. x 2 1/2" long, 10d = 0.148" dia. x 3" long, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long, 8d = 0.131" dia. x 2 1/2" long, 8d x 1 1/2" = 0.131" dia. x 1 1/2" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

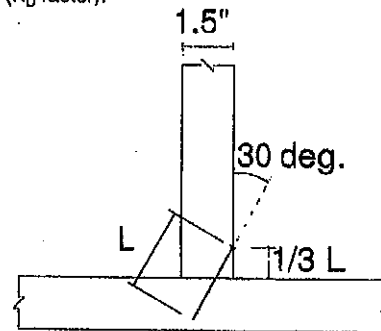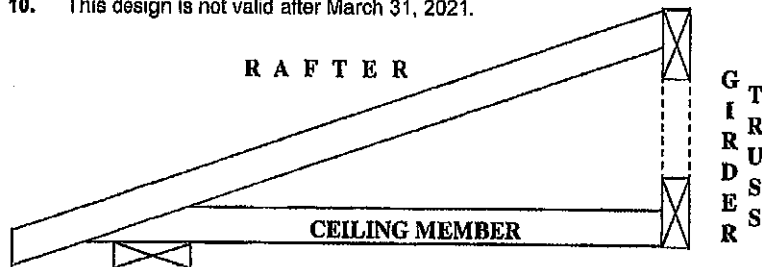


TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (In)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	28	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to wind or earthquake load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

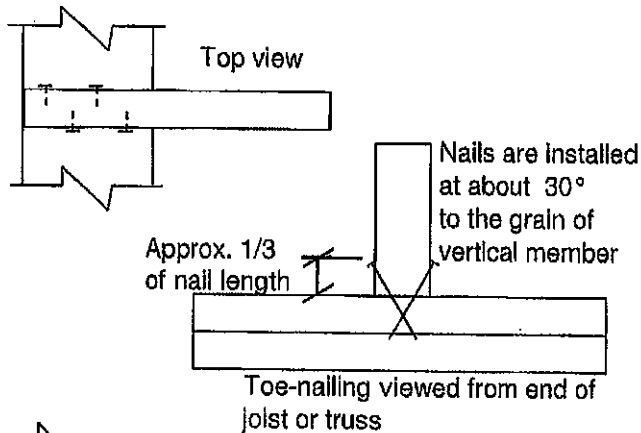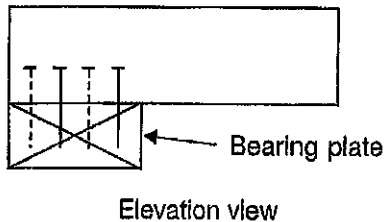

Toe-nailing on 2x4 Bearing Plate

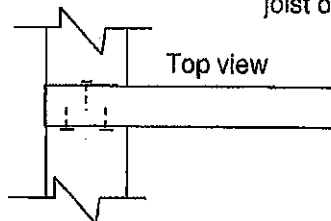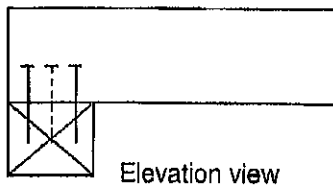

PEO
Certificate No. 10888486.




MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7


December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint, unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/4\" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.

Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

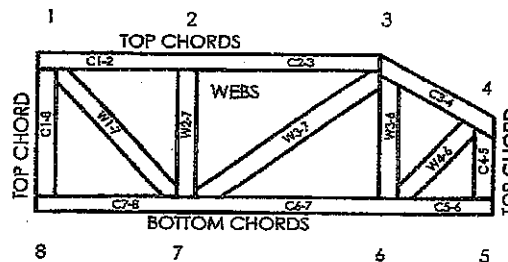

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MTE-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected ovetop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

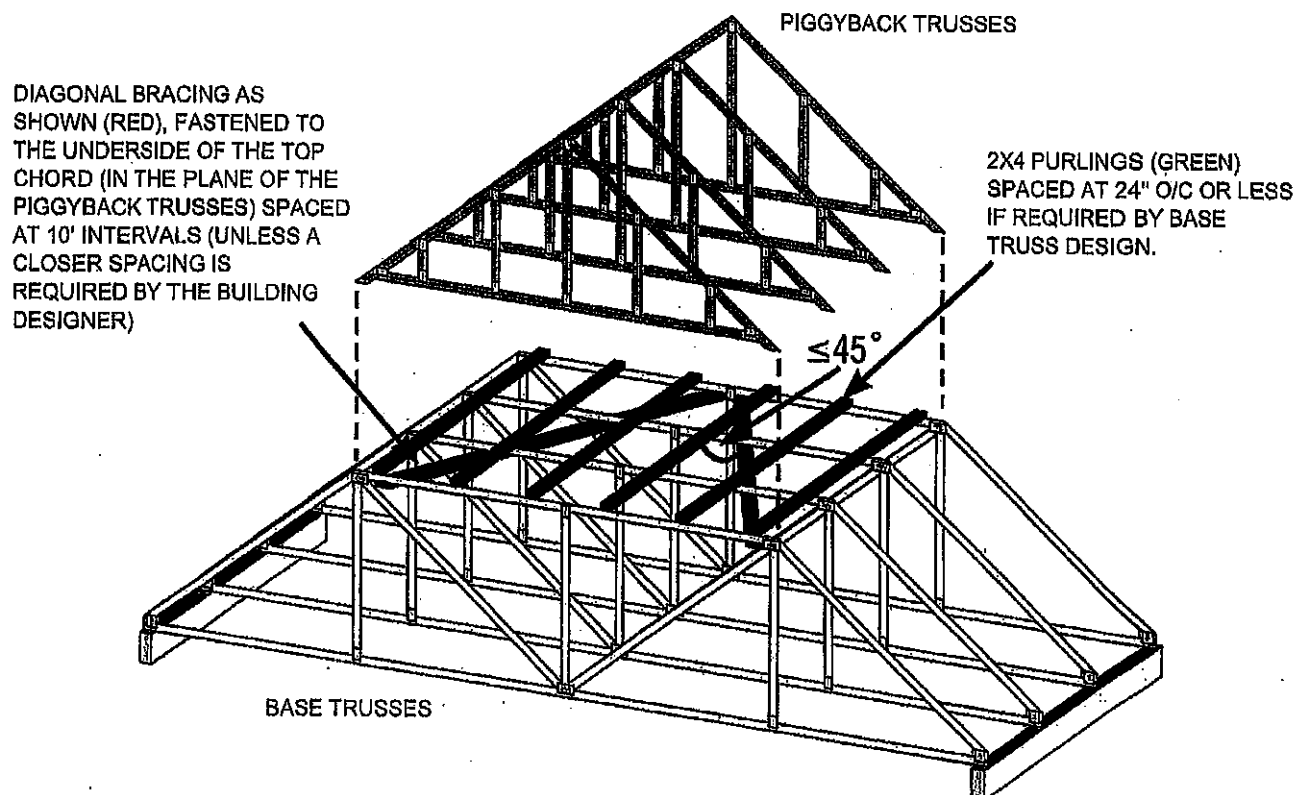

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufacturer's responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1800215

Feb 09, 2018