


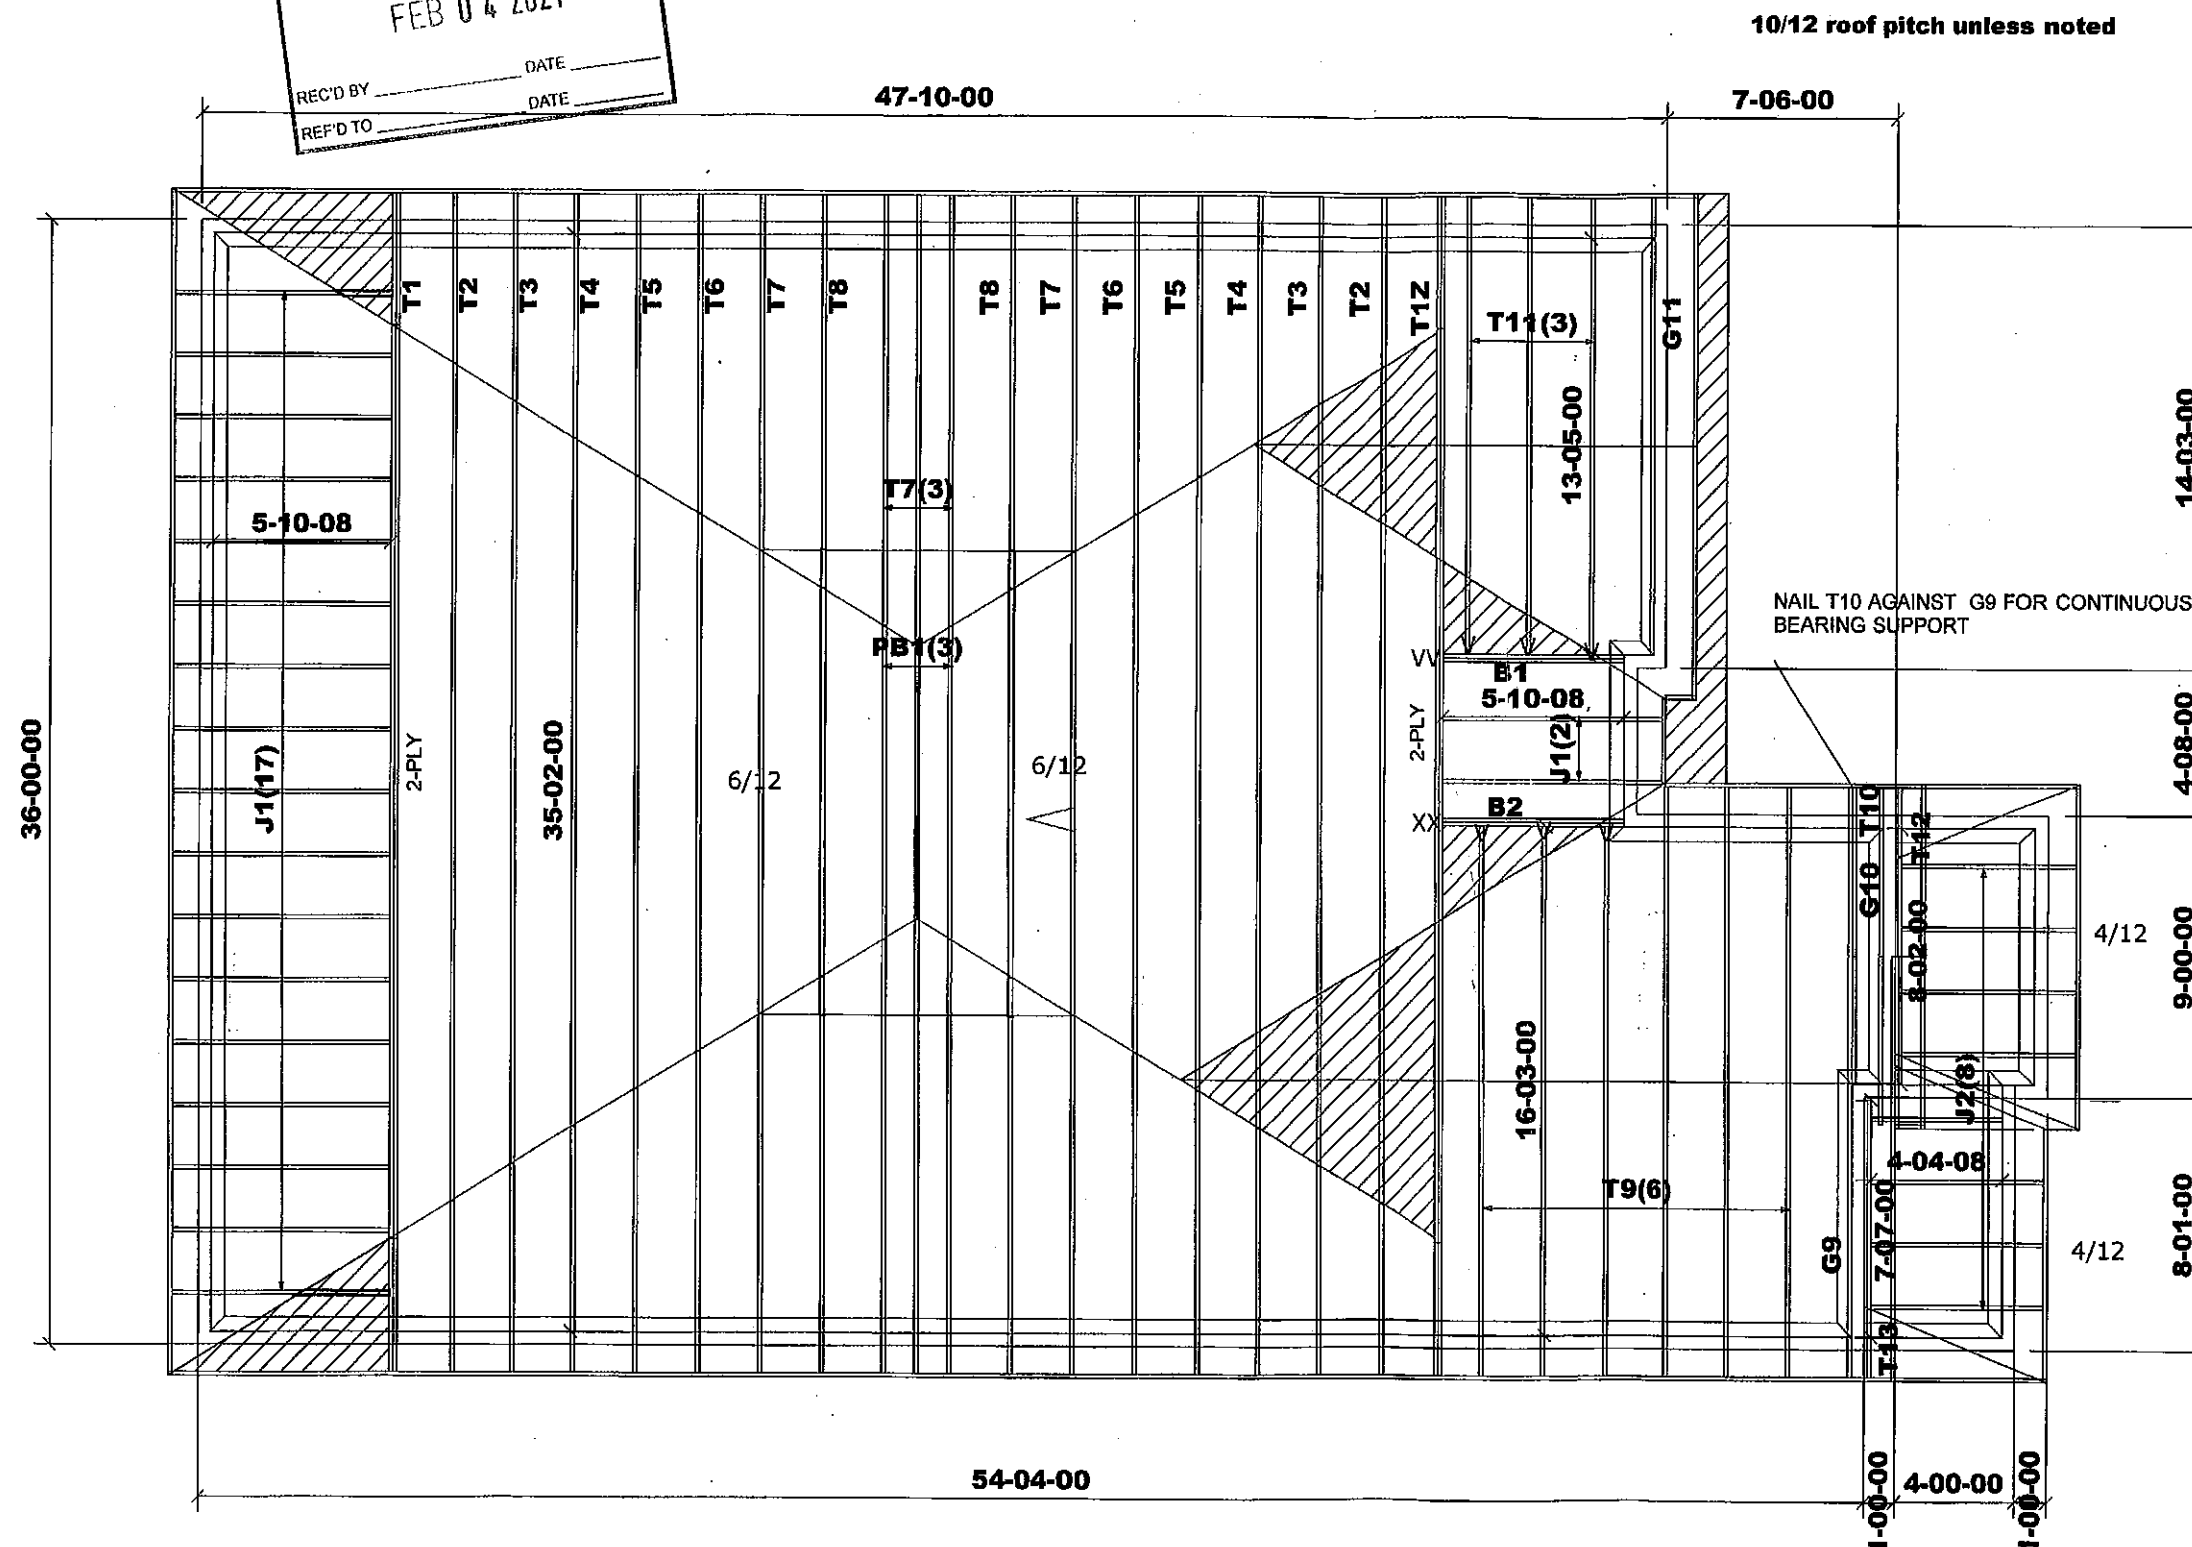

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.


All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf
CITY OF HAMILTON Building Division
Permit No. 21-105899

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
LUS26-2-(VV)
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
these drawings and specifications have been reviewed by
FOR CHIEF BUILDING OFFICIAL
DATE 02/19/21

BEAMS:
B1= B2 = 2 - 2x10 SPF #2

 DENOTES:
CONVENTIONAL
FRAMING

M13126




Job Track: 51225
Plan Log: 202406
Layout ID: 408168

Builder / Location:
GREEN PARK HOMES / WATERDOWN
Project: RUSSELL GARDENS PH.3
Date: 2020-04-27 Sales: Mario DiCano Designer: JG

Model / Elevation:
MOUNTAINASH 5/1- STD OR OPT.5 BR LOT 222
Milek ver 8.3.1.215

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

DELIVERY SHIPLIST

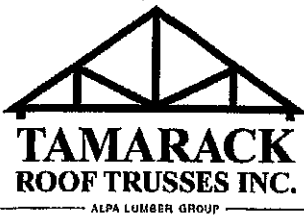

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 5
 Lot #: 222
 Elevation: 1- STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202406
 Layout ID: 408168
 Ref #
 Page: 1 of 2
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	10 / 12	35-02-00	4-01-11	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	385.29 218.00		
	1 2-ply	T12 Hip Girder	10 / 12	35-02-00	4-01-11	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	385.29 218.00		
	2	T2 Hip	10 / 12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	283.44 185.67		
	2	T3 Hip	10 / 12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	296.43 188.67		
	2	T4 Hip	10 / 12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	323.09 204.33		
	2	T5 Hip	10 / 12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	326.19 204.67		
	2	T6 Hip	10 / 12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	363.03 228.67		
	5	T7 Hip	10 / 12	35-02-00	10-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	866.6 540.00		
	2	T8 Hip	10 / 12	35-02-00	11-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	380.38 236.67		
	6	T9 Common	10 / 12	16-03-00	8-04-15	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	480.92 308.00		
	1	G9 GABLE	10 / 12	16-03-00	8-04-15	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	81.49 53.33		
	1	T10 Common	10 / 12	8-02-00	5-00-08	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	38.47 25.83		
	1	G10 GABLE	10 / 12	8-02-00	5-00-08	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	40.07 27.83		
	3	T11 Common	10 / 12	13-05-00	7-02-12	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	191.27 120.50		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 5
 Lot #: 222
 Elevation: 1- STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202406
 Layout ID: 408168
 Ref #
 Page: 2 of 2
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	G11 GABLE	10 /12	13-05-00	7-02-12	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	65.46 42.17		
	1	T12 Hip Girder	10 /12	8-02-00	2-02-08	2 x 4	1-03-08 1-03-08	1-00-07 1-00-07	34.43 25.33		
	1	T13 Half Hip Girder	10 /12	7-07-00	2-02-08	2 x 4	1-03-08	1-00-07 1-09-07	31.77 22.50		
	3	PB1 Piggyback	10 /12	14-10-03	2-00-00	2 x 4			135.57 90.00		
	19	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	319.1 202.67		
	8	J2 Jack-Open	4 /12	4-04-08	2-02-06	2 x 4	1-03-08	3-15 1-09-07	95.29 64.00		

TOTAL # TRUSS= 66 TOTAL BFT OF ALL TRUSSES= 3206.84 BFT. TOTAL WEIGHT OF ALL TRSSES 5093.55 LBS

HARDWARE


QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS28-2	
5	Hardware	LJS28DS	
1	Hardware	LUS28-2	

TOTAL NUMBER OF
ITEMS= 7

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408168	T1	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 12:34:48 2020 Page 1
ID:DMCubINVR6TstF0e31v6l_zns11-Mnciq2FIKiqQuZwGH_IYq9JSI_3jk34wGOWeSzNBRL

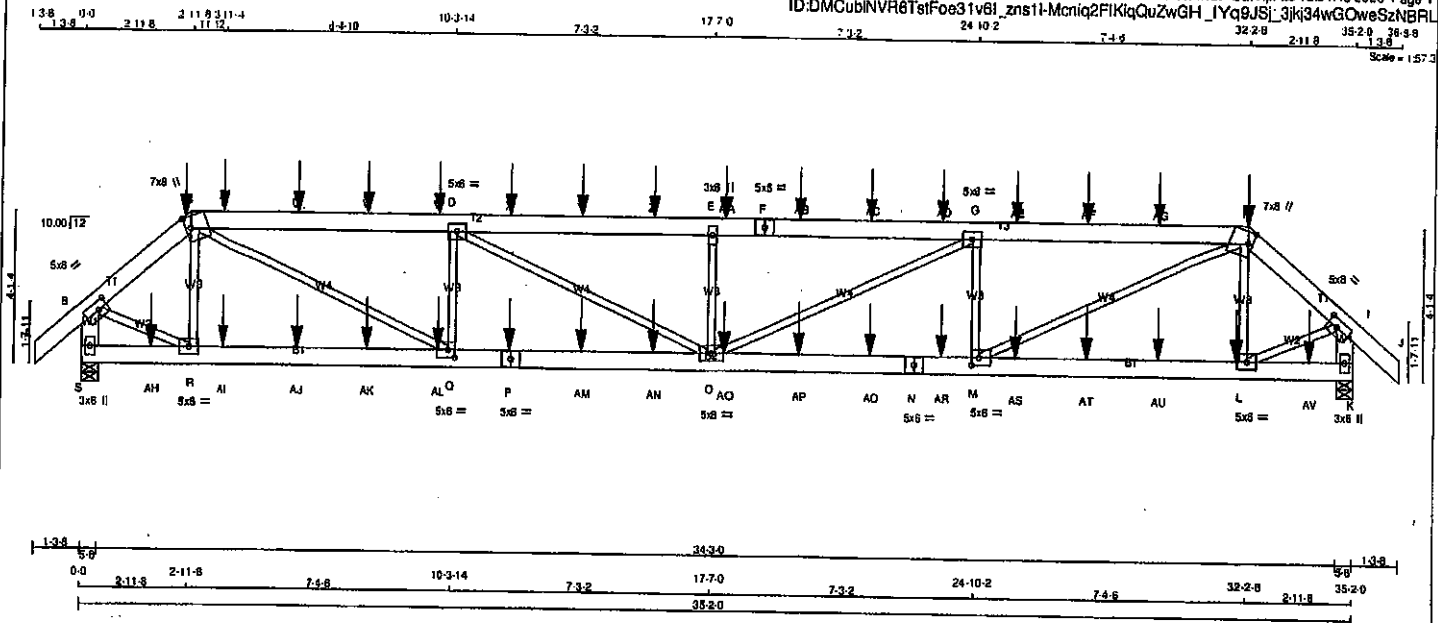

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DRY
A - C	2x6	DRY	No.2
C - F	2x6	DRY	No.2
F - H	2x6	DRY	No.2
H - J	2x6	DRY	No.2
S - B	2x6	DRY	No.2
K - I	2x6	DRY	No.2
S - P	2x6	DRY	2100F 1.8E
P - N	2x6	DRY	2100F 1.8E
N - K	2x6	DRY	2100F 1.8E
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.
DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122'X3') SPIRAL NAILS		
A-C	2	12
C-F	2	12
F-H	2	12
H-J	2	12
S-B	2	12
K-I	2	12
BOTTOM CHORDS : (0.122'X3') SPIRAL NAILS		
S-P	2	12
P-N	2	12
N-K	2	12
WEBS : (0.122'X3') SPIRAL NAILS		
2x3	1	6

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.
TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	GROSS REACTION	JT	GROSS REACTION	JT	GROSS REACTION	JT	GROSS REACTION	JT	GROSS REACTION
S	3330	0	3330	0	3330	0	3330	0	3330
K	3379	0	3379	0	3379	0	3379	0	3379

UNFACTORED REACTIONS
1ST LOASE MAX/MIN COMPONENT REACTIONS
JT COMBINED SNOW LIVE PERM LIVE WIND DEAD SOIL
S 2354 1553 / 0 0 / 0 0 / 0 0 / 0 0 / 0 0 / 0 0 / 0 0 / 0 0
K 2388 1572 / 0 0 / 0 0 / 0 0 / 0 0 / 0 0 / 0 0 / 0 0 / 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K
BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.98 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.
LOADING
TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0 / 42	R-C	-650 / 0
B-C	-3387 / 0	C-Q	0 / 4509
C-T	-6802 / 0	Q-D	-1799 / 0
T-U	-6802 / 0	D-O	0 / 1370
U-V	-6802 / 0	O-E	-987 / 0
V-W	-6802 / 0	E-G	0 / 1382
W-D	-6802 / 0	G-H	-1787 / 0
D-X	-7828 / 0	H-I	0 / 4481
X-Y	-7828 / 0	I-H	-861 / 0
Y-Z	-7828 / 0	H-I	0 / 2738
Z-E	-7828 / 0	L-I	0 / 2771
EA-AA	-7828 / 0		
AA-F	-7828 / 0		
F-AB	-7828 / 0		
AB-AC	-7828 / 0		
AC-AD	-7828 / 0		
AD-G	-7828 / 0		
G-AE	-6808 / 0		
AE-AF	-6808 / 0		
AF-AG	-6808 / 0		
AG-H	-6808 / 0		
H-I	-3410 / 0		
I-J	0 / 42		
S-B	-3375 / 0		
K-I	-3414 / 0		

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0 / 42	R-C	-650 / 0
B-C	-3387 / 0	C-Q	0 / 4509
C-T	-6802 / 0	Q-D	-1799 / 0
T-U	-6802 / 0	D-O	0 / 1370
U-V	-6802 / 0	O-E	-987 / 0
V-W	-6802 / 0	E-G	0 / 1382
W-D	-6802 / 0	G-H	-1787 / 0
D-X	-7828 / 0	H-I	0 / 4481
X-Y	-7828 / 0	I-H	-861 / 0
Y-Z	-7828 / 0	H-I	0 / 2738
Z-E	-7828 / 0	L-I	0 / 2771
EA-AA	-7828 / 0		
AA-F	-7828 / 0		
F-AB	-7828 / 0		
AB-AC	-7828 / 0		
AC-AD	-7828 / 0		
AD-G	-7828 / 0		
G-AE	-6808 / 0		
AE-AF	-6808 / 0		
AF-AG	-6808 / 0		
AG-H	-6808 / 0		
H-I	-3410 / 0		
I-J	0 / 42		
S-B	-3375 / 0		
K-I	-3414 / 0		

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD)
EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/899 (0.20")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/899 (0.37")

CSI: TC=0.42/1.00 (D-E:1), BC=0.22/1.00 (O-Q:1),
WB=0.58/1.00 (C-Q:1), SSI=0.22/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1687 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.89 (H) (INPUT = 0.90)
JSI METAL=0.65 (N) (INPUT = 1.00)



Structural component only
DWG# T-2007129 1/2

JOB NAME 408168	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:34:48 2020 Page 2
ID:DMCubiNVR6TsiFoe931v6I_zns11-Mon1a2FIKlQQuZwGH_1Yg9JSi_3JkI34wGOweSzNBRL

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW-t	MT20	5.0	8.0	2.50	3.25
C	TTWW+m	MT20	7.0	8.0	3.75	1.50
D	TMW-t	MT20	5.0	6.0		
E	TMW+w	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMW-t	MT20	5.0	8.0		
H	TTWW+m	MT20	7.0	8.0	3.75	1.50
I	TMW-t	MT20	5.0	8.0	2.50	3.25
K	BMV1+p	MT20	3.0	6.0		
L	BMW-t	MT20	5.0	6.0		
M	BMWW-t	MT20	5.0	6.0	2.50	2.25
N	BS-t	MT20	5.0	6.0		
O	BMWW-t	MT20	5.0	6.0		
P	BS-t	MT20	5.0	6.0		
Q	BMWW-t	MT20	5.0	6.0	2.50	2.25
R	BMW-t	MT20	5.0	6.0		
S	BMV1+p	MT20	3.0	6.0		

LOADING

TOTAL LOAD CASES: (4)

CHORDS

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD LC1 (LC)	MAX. FACTORED UNBRAC LENGTH FR-TO
FR-TO				
M-AS	0 / 2586	-18.5	-18.5 0.12 (1)	10.00
AS-AT	0 / 2586	-18.5	-18.5 0.12 (1)	10.00
AT-AU	0 / 2586	-18.5	-18.5 0.12 (1)	10.00
AU-L	0 / 2586	-18.5	-18.5 0.12 (1)	10.00
L-AV	0 / 0	-18.5	-18.5 0.05 (1)	10.00
AV-K	0 / 0	-18.5	-18.5 0.06 (1)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-11-8	-38	-42	---	FRONT	VERT	DEAD	---	C1
C	2-11-8	-191	-191	---	FRONT	VERT	SNOW	---	C1
H	32-2-8	-38	-42	---	FRONT	VERT	DEAD	---	C1
H	32-2-8	-118	-118	---	FRONT	VERT	TOTAL	---	C1
H	32-2-8	-191	-191	---	FRONT	VERT	SNOW	---	C1
L	31-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
P	11-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
T	3-11-4	-111	-111	---	FRONT	VERT	TOTAL	---	C1
U	5-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	17-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	19-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	21-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	23-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	25-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	27-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AG	29-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AH	1-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AI	3-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AJ	5-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AK	7-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AL	9-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AM	13-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AN	15-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AO	17-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AP	19-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AQ	21-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AR	23-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AS	25-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AT	27-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AU	29-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AV	33-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007129

JOB NAME 408168	TRUSS NAME T1Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Sat Apr 25 12:24:49 2020 Page 2
ID:DMCubINVR8TstFog31v6l zns1l-qoL41NGw50yHWIVSrgnNNrbzQizT4?D9w8UJBuzNBRK

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	6.0	9.0		
C	TTWW+m	MT20	8.0	9.0	Edge	6.50
D	TMWW-l	MT20	5.0	6.0	2.50	2.50
E	TMW+w	MT20	3.0	6.0		
F	TS-l	MT20	5.0	6.0		
G	TMWW-l	MT20	5.0	6.0	2.50	2.50
H	TTWW+m	MT20	8.0	9.0	Edge	6.50
I	TMVW+p	MT20	6.0	9.0		
K	BMV1+p	MT20	3.0	6.0		
L	BMWW-l	MT20	5.0	6.0	2.50	2.75
M	BMWW-l	MT20	5.0	8.0	2.50	2.00
N	BS-l	MT20	6.0	9.0		
O	BMWWW-l	MT20	5.0	12.0	3.00	6.00
P	BS-l	MT20	6.0	9.0		
Q	BMWW-l	MT20	5.0	8.0	2.50	2.00
R	BMWW-l	MT20	5.0	6.0	2.50	2.75
S	BMV1+p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2007130 92

JOB NAME 408168	TRUSS NAME T2	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:34:50 2020 Page 1
 ID:DMCubINVR6Tsifoe31v6l_zns1H?vsFjH2sJ487s3IPPKQvaOkao10CiaMOat1IKzNBRJ
 Scale = 1:57.3

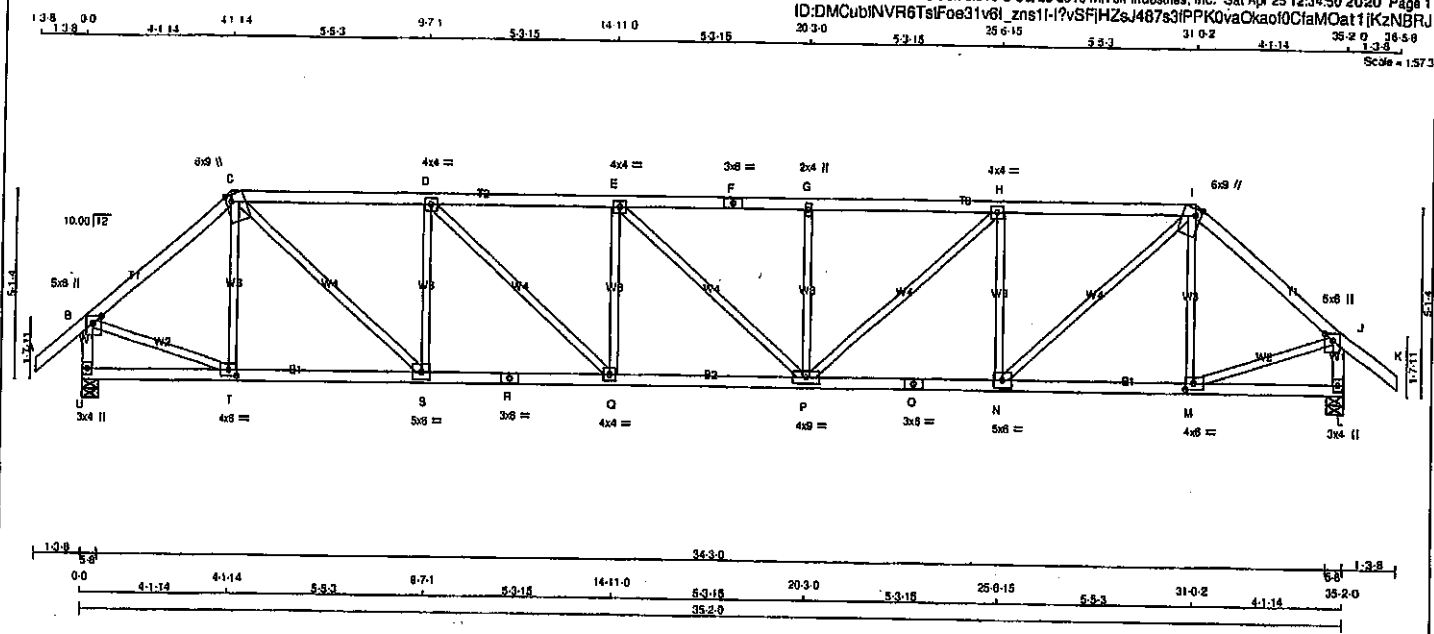

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
I - L	2x4	DRY	No.2	SPF
L - O	2x4	DRY	No.2	SPF
O - R	2x4	DRY	No.2	SPF
R - U	2x4	DRY	No.2	SPF
U - X	2x4	DRY	No.2	SPF
X - Z	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TTWW+P	MT20	5.0	6.0	Edge 2.75
C	TTWW+m	MT20	6.0	9.0	Edge 1.75
D, E, H					
D	TTWW+I	MT20	4.0	4.0	
F	TS-I	MT20	3.0	6.0	
G	TTWW+W	MT20	2.0	6.0	
I	TTWW+m	MT20	6.0	9.0	Edge 1.75
J	TTWW+P	MT20	5.0	6.0	Edge 2.75
L	BMV1+P	MT20	3.0	4.0	
M	BMWW-I	MT20	4.0	6.0	2.00 2.75
N	BMWW-I	MT20	5.0	6.0	
O	BS-I	MT20	3.0	6.0	
P	BMWW+I	MT20	4.0	9.0	
Q	BMWW+I	MT20	4.0	4.0	
R	BS-I	MT20	3.0	6.0	
S	BMWW-I	MT20	5.0	6.0	
T	BMWW-I	MT20	4.0	6.0	2.00 2.75
U	BMV1+P	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UP/LIFT	IN-SX
U	2086	0	0	5-8
L	2086	0	0	5-8

UNFACTORED REACTIONS

	1ST LOOSE	MAX. MIN. COMPONENT REACTIONS
	COMBINED	SNOW
JT	1458	971 / 0
U	1458	971 / 0
L	1458	971 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.20 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. OSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. OSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	T-C	-358 / 0	0.14 (1)	
B-C	-1960 / 0	-91.8	-91.8 0.38 (1)	C-S	0 / 1836	0.41 (1)	
C-D	-2871 / 0	-91.8	-91.8 0.57 (1)	S-D	-1118 / 0	0.43 (1)	
D-E	-3508 / 0	-91.8	-91.8 0.65 (1)	D-Q	0 / 856	0.19 (1)	
E-F	-3505 / 0	-91.8	-91.8 0.53 (1)	Q-E	-476 / 0	0.18 (1)	
F-G	-3505 / 0	-91.8	-91.8 0.53 (1)	E-P	-2 / 0	0.00 (1)	
G-H	-3505 / 0	-91.8	-91.8 0.56 (1)	P-Q	-474 / 0	0.18 (1)	
H-I	-2871 / 0	-91.8	-91.8 0.57 (1)	Q-H	0 / 853	0.19 (1)	
I-J	-1960 / 0	-91.8	-91.8 0.38 (1)	H-N	-1117 / 0	0.43 (1)	
J-K	0 / 41	-91.8	-91.8 0.13 (1)	N-I	0 / 1837	0.41 (1)	
U-B	-2037 / 0	0.0	0.0 0.22 (1)	M-I	-358 / 0	0.14 (1)	
L-J	-2037 / 0	0.0	0.0 0.22 (1)	I-T	0 / 1571	0.35 (1)	
U-T	0 / 0	-18.5	-18.5 0.10 (4)	M-J	0 / 1571	0.35 (1)	
T-S	0 / 1494	-18.5	-18.5 0.30 (1)				
S-R	0 / 2871	-18.5	-18.5 0.51 (1)				
R-Q	0 / 2871	-18.5	-18.5 0.51 (1)				
Q-P	0 / 3508	-18.5	-18.5 0.62 (1)				
P-O	0 / 2872	-18.5	-18.5 0.51 (1)				
O-N	0 / 2872	-18.5	-18.5 0.51 (1)				
N-M	0 / 1494	-18.5	-18.5 0.30 (1)				
M-L	0 / 0	-18.5	-18.5 0.10 (4)				

TOTAL WEIGHT = 2 X 147 = 293 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")

CALCULATED VERT. DEFL.(LL) = 1/999 (0.20")

ALLOWABLE DEFL.(TL) = L/360 (1.17")

CALCULATED VERT. DEFL.(TL) = 1/999 (0.39")

CSI: TC=0.68/1.00 (Q-H:1), BC=0.62/1.00 (P-Q:1), WB=0.43/1.00 (D-S:1), SS=0.23/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (N) (INPUT = 0.90)


JSI METAL = 0.90 (O) (INPUT = 1.00)

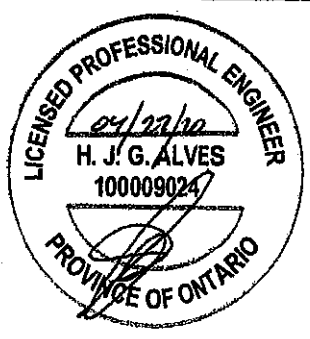

Structural component only
 DWG# T-2007131

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T3	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:51 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns11-mBTtS3BddC7Idery7rFSoxJJC1Ex4wWcEdaFnzNBRI

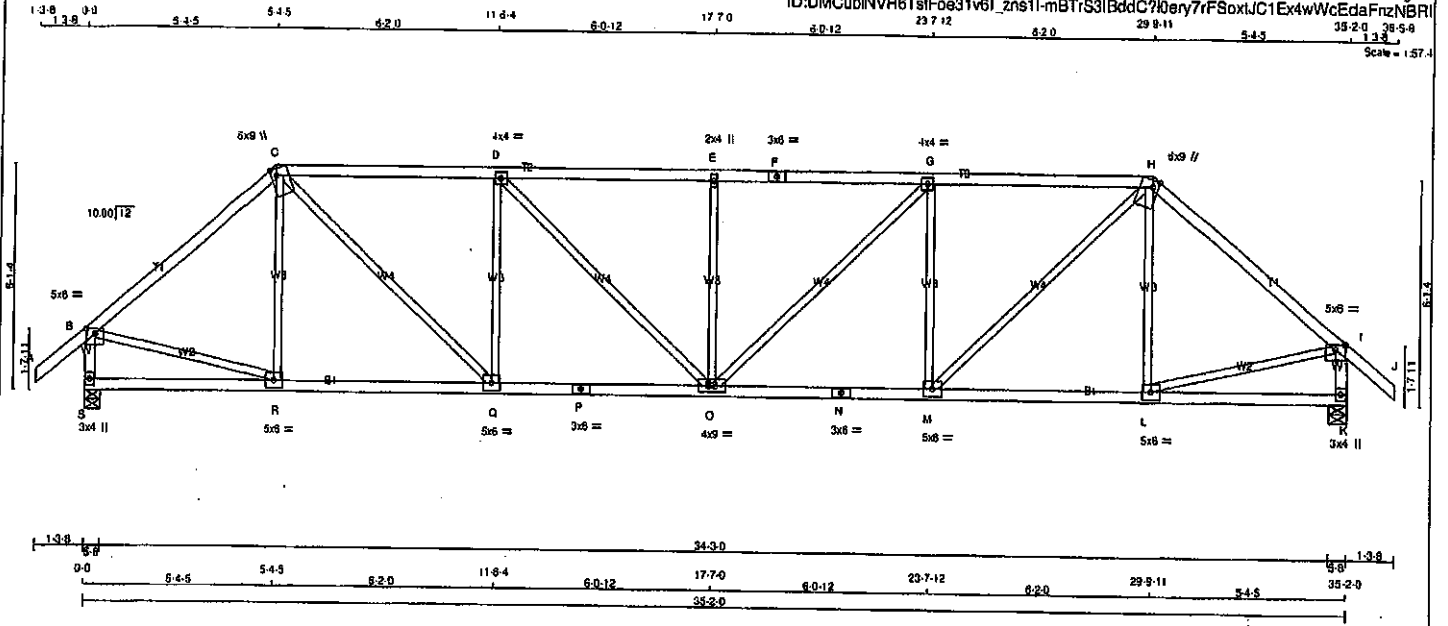

TOTAL WEIGHT = 2 X 148 = 296 LB (M)

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - F	2x4	DRY No.2	SPF
F - H	2x4	DRY No.2	SPF
H - J	2x4	DRY No.2	SPF
S - B	2x4	DRY No.2	SPF
K - I	2x4	DRY No.2	SPF
S - P	2x4	DRY No.2	SPF
P - N	2x4	DRY No.2	SPF
N - K	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMWV-p	MT20	5.0	6.0	1.50 3.00
C	TTWW-m	MT20	6.0	9.0	Edge 1.75
D	TMWV-i	MT20	4.0	4.0	
E	TMW-w	MT20	2.0	4.0	
F	TS-i	MT20	3.0	6.0	
G	TMWV-i	MT20	6.0	9.0	Edge 1.75
H	TTWW-m	MT20	4.0	4.0	
I	TMWV-p	MT20	5.0	6.0	1.50 3.00
K	BMV-i-p	MT20	3.0	4.0	
L, M, Q, R					
L	BMWV-i	MT20	5.0	6.0	
N	BS-i	MT20	3.0	6.0	
O	BMWV-w	MT20	4.0	9.0	
P	BS-i	MT20	3.0	6.0	
S	BMV-i-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
S	2088	0	2088	0	5-8
K	2088	0	2088	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS					
S	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL	
K	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	
	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.28 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO				FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	R-C	-246 / 7	0.14 (1)	
B-C	-2004 / 0	-91.8	-91.8 0.84 (1)	C-Q	0 / 1538	0.35 (1)	
C-D	-2653 / 0	-91.8	-91.8 0.74 (1)	Q-D	-943 / 0	0.55 (1)	
D-E	-2378 / 0	-91.8	-91.8 0.78 (1)	D-O	0 / 450	0.10 (1)	
E-F	-2378 / 0	-91.8	-91.8 0.78 (1)	O-E	-512 / 0	0.30 (1)	
F-G	-2378 / 0	-91.8	-91.8 0.78 (1)	O-G	0 / 450	0.10 (1)	
G-H	-2378 / 0	-91.8	-91.8 0.74 (1)	M-G	-943 / 0	0.55 (1)	
H-I	-2004 / 0	-91.8	-91.8 0.84 (1)	M-H	0 / 1538	0.35 (1)	
I-J	0 / 41	-91.8	-91.8 0.13 (1)	L-H	-246 / 7	0.14 (1)	
S-B	-2028 / 0	0.0	0.0 0.22 (1)	B-R	0 / 1580	0.36 (1)	
K-I	-2028 / 0	0.0	0.0 0.22 (1)	L-I	0 / 1580	0.38 (1)	
S-R	0 / 0	-18.5	-18.5 0.14 (4)				
R-Q	0 / 1532	-18.5	-18.5 0.33 (1)				
Q-P	0 / 2653	-18.5	-18.5 0.49 (1)				
P-O	0 / 2653	-18.5	-18.5 0.49 (1)				
O-N	0 / 2653	-18.5	-18.5 0.49 (1)				
N-M	0 / 2653	-18.5	-18.5 0.49 (1)				
M-L	0 / 1532	-18.5	-18.5 0.33 (1)				
L-K	0 / 0	-18.5	-18.5 0.14 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (1.17")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.16")
ALLOWABLE DEFL. (TL) = $L/360$ (1.17")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.29")

CSI: TC=0.78/1.00 (E-G:1), BC=0.48/1.00 (M-O:1),
WB=0.55/1.00 (G-M:1), SS=0.27/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1897 1658


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.90 (B) (INPUT = 0.90)
JSI METAL = 0.85 (N) (INPUT = 1.00)

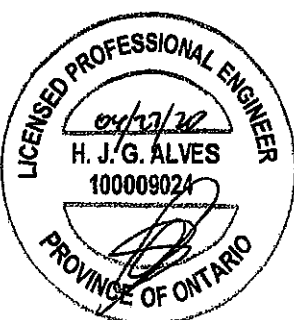

Structural component only
DWG# T-2007132

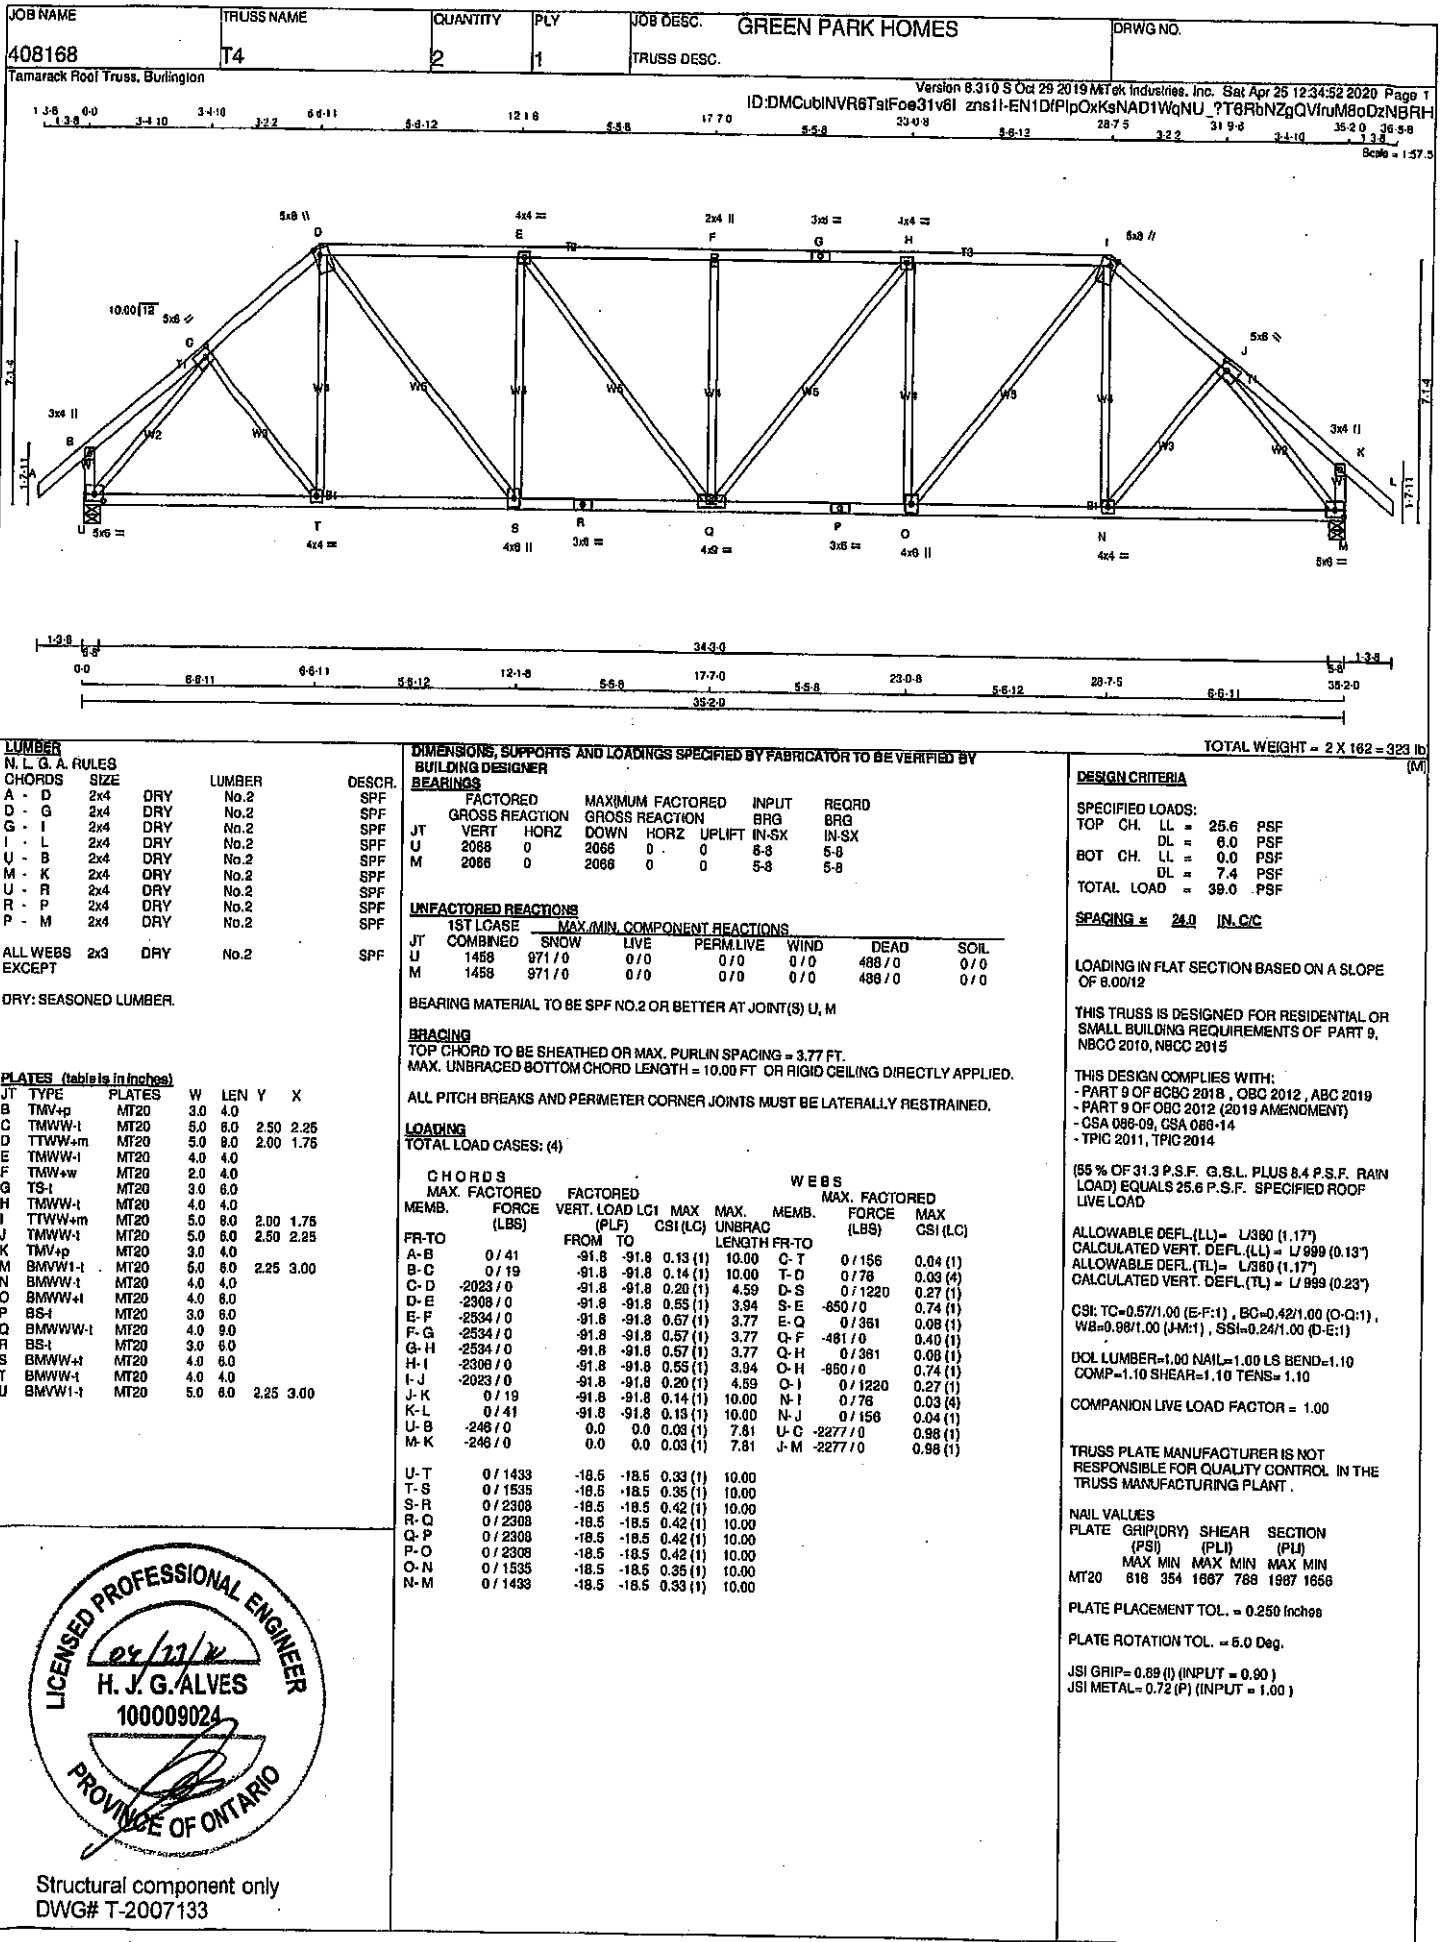

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T5	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

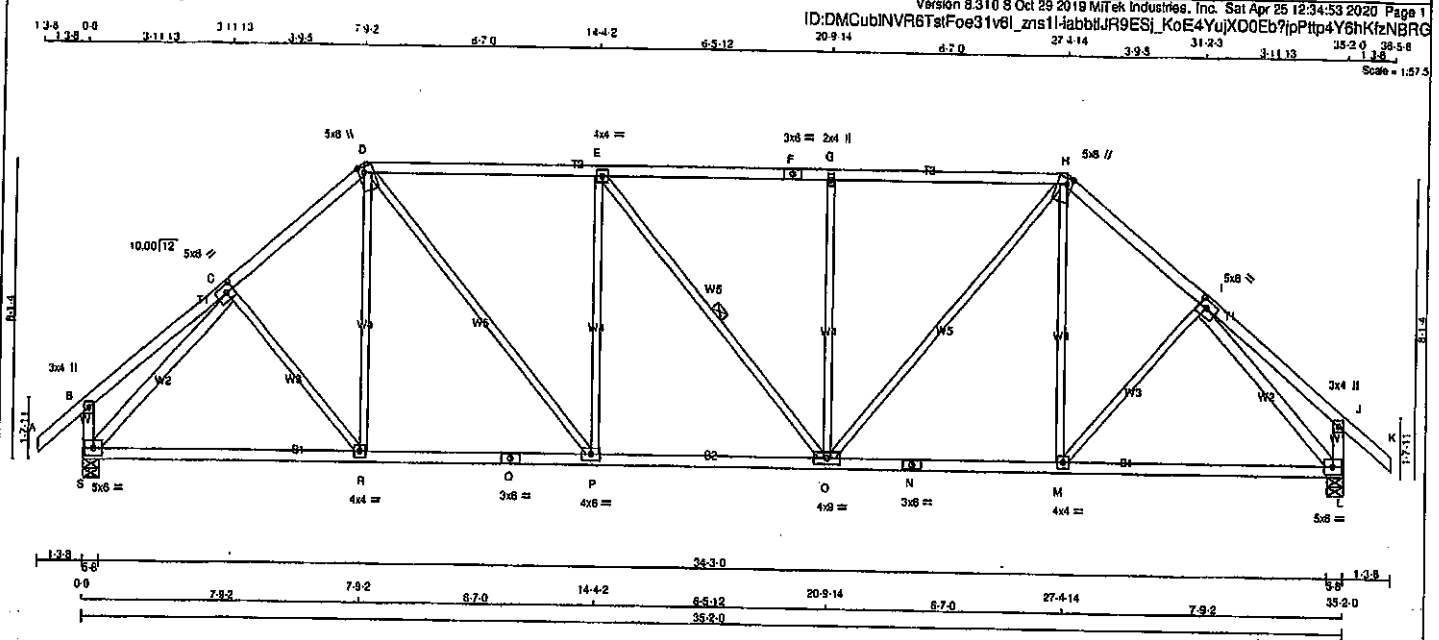

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				TOTAL WEIGHT = 2 X 163 = 326 lb			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG		
A - D	2x4	DRY	No.2	SPF	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
D - F	2x4	DRY	No.2	SPF	S	2068	0	2068	0	0	5-8
F - H	2x4	DRY	No.2	SPF	L	2068	0	2068	0	0	5-8
H - K	2x4	DRY	No.2	SPF							
S - B	2x4	DRY	No.2	SPF	UNFACTORED REACTIONS						
L - J	2x4	DRY	No.2	SPF	1ST CASE MAX./MIN. COMPONENT REACTIONS						
S - Q	2x4	DRY	No.2	SPF	JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
Q - N	2x4	DRY	No.2	SPF	S	1458	871 / 0	0 / 0	0 / 0	0 / 0	488 / 0
N - L	2x4	DRY	No.2	SPF	L	1458	871 / 0	0 / 0	0 / 0	0 / 0	488 / 0
ALL WEBS 2x3 DRY No.2				SPF	BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L						
EXCEPT				SPF							
S - C 2x4 DRY No.2				SPF							
I - L 2x4 DRY No.2				SPF							

DRY: SEASONED LUMBER.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")

CALCULATED VERT. DEFL.(LL) = L/999 (0.10")

ALLOWABLE DEFL.(TL) = L/360 (1.17")

CALCULATED VERT. DEFL.(TL) = L/999 (0.21")

CSI: TC=0.73/1.00 (D-E:1), BC=0.42/1.00 (O-P:1), WB=0.97/1.00 (L-L:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	C-R	0 / 64	0.02 (4)
B-C	0 / 28	-91.8	-91.8 0.21 (1)	10.00	R-D	0 / 128	0.04 (4)
C-D	-2068 / 0	-91.8	-91.8 0.29 (1)	4.50	D-P	0 / 998	0.22 (1)
D-E	-2163 / 0	-91.8	-91.8 0.73 (1)	3.81	P-E	-850 / 0	0.82 (1)
E-F	-2162 / 0	-91.8	-91.8 0.73 (1)	3.81	E-O	-2 / 0	0.00 (1)
F-G	-2162 / 0	-91.8	-91.8 0.73 (1)	3.81	O-G	-649 / 0	0.82 (1)
G-H	-2162 / 0	-91.8	-91.8 0.73 (1)	3.81	H-M	0 / 998	0.22 (1)
H-I	-2068 / 0	-91.8	-91.8 0.29 (1)	4.50	M-H	0 / 128	0.04 (4)
I-J	0 / 28	-91.8	-91.8 0.21 (1)	10.00	M-I	0 / 64	0.02 (4)
J-K	0 / 41	-91.8	-91.8 0.13 (1)	10.00	S-C	-2291 / 0	0.97 (1)
S-B	-284 / 0	0.0	0.0 0.03 (1)	7.81	I-L	-2291 / 0	0.97 (1)
L-J	-284 / 0	0.0	0.0 0.03 (1)	7.81			

S-R	0 / 1487	-18.5	-18.5 0.88 (1)	10.00
R-Q	0 / 1519	-18.5	-18.5 0.39 (1)	10.00
Q-P	0 / 1519	-18.5	-18.5 0.39 (1)	10.00
P-O	0 / 2163	-18.5	-18.5 0.42 (1)	10.00
O-N	0 / 1519	-18.5	-18.5 0.39 (1)	10.00
N-M	0 / 1519	-18.5	-18.5 0.39 (1)	10.00
M-L	0 / 1487	-18.5	-18.5 0.39 (1)	10.00

Structural component only
DWG# T-2007134

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 818 354 1887 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.87 (6) (INPUT = 0.90)

JSI METAL = 0.58 (6) (INPUT = 1.00)

JOB NAME 408168	TRUSS NAME T6	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:34:55 2020 Page 1
ID:DMCubINVR6TsIFoe31v6l_2ns1l-ayilLIRLhhsiQEaycBzwBoe5IFpQxmr5XsboOYzNBRE
Scale = 1:2.7

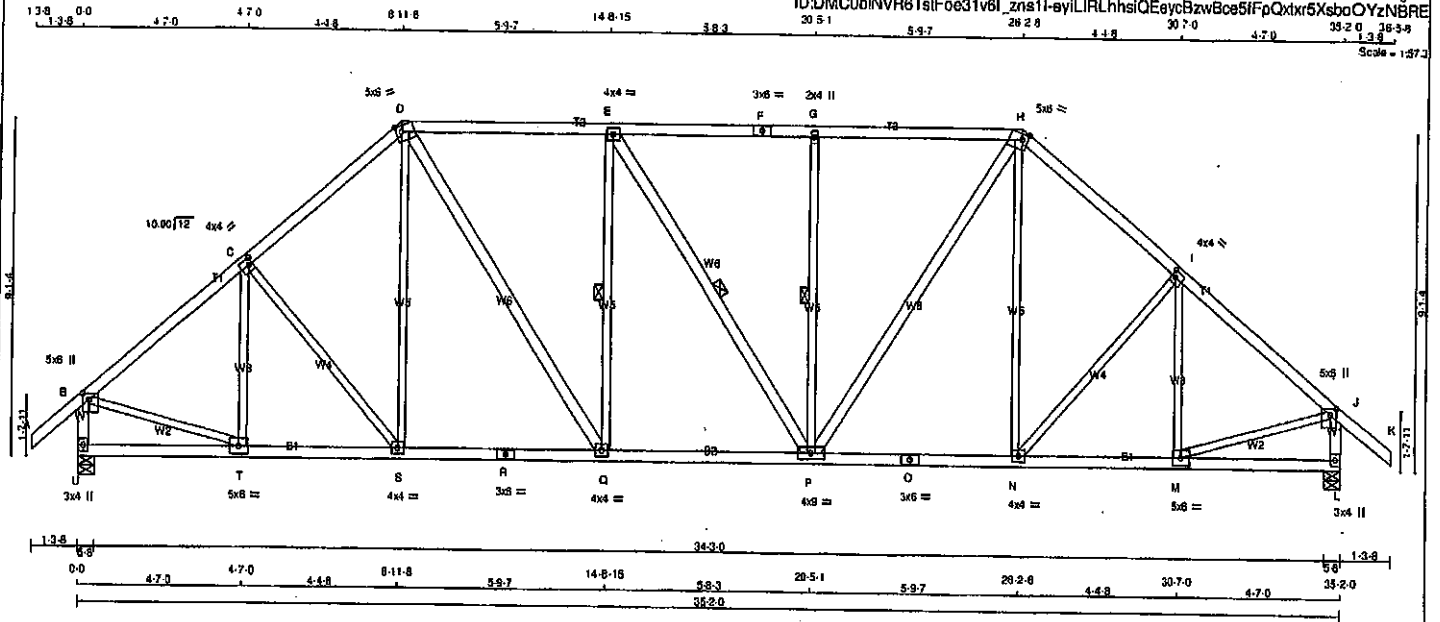

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
D - Q	2x4	DRY	No.2
E - P	2x4	DRY	No.2
P - H	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMW-w	MT20	5.0	6.0	2.00	2.00
C TMW-w	MT20	4.0	4.0	2.00	1.25
D TTW-m	MT20	5.0	6.0	2.00	1.75
E TMW-w	MT20	4.0	4.0		
F TS-l	MT20	3.0	6.0		
G TMW-w	MT20	2.0	4.0		
H TTW-m	MT20	5.0	6.0	2.00	1.75
I TMW-w	MT20	4.0	4.0	2.00	1.25
J TMW-w	MT20	5.0	6.0	2.00	2.00
L BMV-l+p	MT20	3.0	4.0		
M BMW-w	MT20	5.0	6.0		
N, Q, S					
N BMW-w	MT20	4.0	4.0		
O BS-l	MT20	3.0	6.0		
P BMW-w	MT20	4.0	6.0		
R BS-l	MT20	3.0	6.0		
T BMW-w	MT20	5.0	6.0		
U BMV-l+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT REORD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
U	2068	0	2068	0	5-8
L	2068	0	2068	0	5-8

UNFACTORED REACTIONS		MAX/MIN. COMPONENT REACTIONS	
JT	1ST CASE	SNOW	LIVE
U	1458	971 / 0	0 / 0
L	1458	971 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.44 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, E-P, Q-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
A-B	0 / 41	-91.8	-91.8 0.13 (1)	T-C	-357 / 0
B-C	-1994 / 0	-91.8	-91.8 0.30 (1)	C-S	-121 / 0
C-D	-1957 / 0	-91.8	-91.8 0.29 (1)	S-D	0 / 188
D-E	-1923 / 0	-91.8	-91.8 0.40 (1)	D-Q	0 / 810
E-F	-1921 / 0	-91.8	-91.8 0.37 (1)	Q-E	-569 / 0
F-G	-1921 / 0	-91.8	-91.8 0.37 (1)	E-P	-3 / 0
G-H	-1921 / 0	-91.8	-91.8 0.40 (1)	P-G	-568 / 0
H-I	-1957 / 0	-91.8	-91.8 0.29 (1)	N-H	0 / 807
I-J	-1994 / 0	-91.8	-91.8 0.30 (1)	H-I	0 / 189
J-K	0 / 41	-91.8	-91.8 0.13 (1)	N-I	-121 / 0
U-B	-2028 / 0	0.0	0.0 0.22 (1)	M-I	-358 / 0
L-J	-2028 / 0	0.0	0.0 0.22 (1)	B-T	0 / 1617
				M-J	0 / 1617
U-T	0 / 0	-18.5	-18.5 0.08 (4)		
T-S	0 / 1555	-18.5	-18.5 0.30 (1)		
S-R	0 / 1477	-18.5	-18.5 0.30 (1)		
R-Q	0 / 1477	-18.5	-18.5 0.30 (1)		
Q-P	0 / 1923	-18.5	-18.5 0.38 (1)		
P-O	0 / 1476	-18.5	-18.5 0.30 (1)		
O-N	0 / 1476	-18.5	-18.5 0.30 (1)		
N-M	0 / 1555	-18.5	-18.5 0.31 (1)		
M-L	0 / 0	-18.5	-18.5 0.08 (4)		

TOTAL WEIGHT = 2 X 182 = 363 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = 1/899 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.16")

CSI: TC=0.40/1.00 (D-E:1), BC=0.38/1.00 (P-Q:1), WB=0.38/1.00 (B-T:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (B) (INPUT = 0.90)
JSI METAL = 0.50 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007135

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T7	5	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

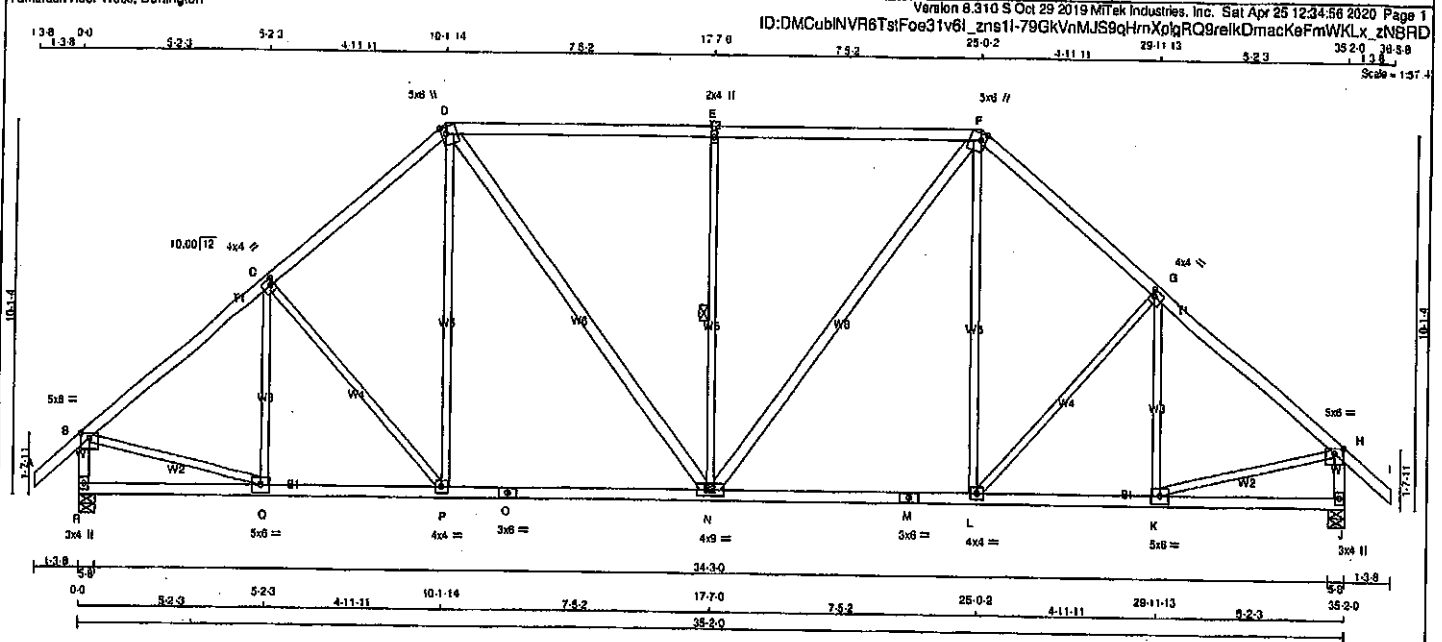

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
EXCEPT			
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMW-p	MT20	5.0	6.0 1.50 3.00
C	TMW-w	MT20	4.0	4.0 2.00 1.25
D	TTW-w	MT20	5.0	6.0 2.25 1.50
E	TMW-w	MT20	2.0	4.0
F	TTW-w	MT20	5.0	6.0 2.25 1.50
G	TMW-w	MT20	4.0	4.0 2.00 1.25
H	TMW-p	MT20	5.0	6.0 1.50 3.00
J	BMV-p	MT20	3.0	4.0
K	BMW-t	MT20	5.0	6.0
L	BMW-t	MT20	4.0	4.0
M	BS-i	MT20	3.0	6.0
N	BMW-w	MT20	4.0	9.0
O	BS-i	MT20	3.0	6.0
P	BMW-t	MT20	4.0	4.0
Q	BMW-t	MT20	5.0	6.0
R	BMV-p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
JT	VERT	2068	0	2068	0	5-8	5-8
R	VERT	2068	0	2068	0	5-8	5-8
J	VERT	2068	0	2068	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1458	971/0	0/0	0/0	0/0	488/0	0/0
J	1458	971/0	0/0	0/0	0/0	488/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.98 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO			
A-B	0/41	-91.8	-91.8 0.13 (1)	10.00	Q-C	-302/0	0.17 (1)
B-C	-2021/0	-91.8	-91.8 0.39 (1)	4.41	C-P	-217/0	0.25 (1)
C-D	-1908/0	-91.8	-91.8 0.37 (1)	4.52	P-D	0/278	0.08 (1)
D-E	-1809/0	-91.8	-91.8 0.74 (1)	3.98	D-N	0/615	0.10 (1)
E-F	-1809/0	-91.8	-91.8 0.74 (1)	3.98	N-E	-838/0	0.58 (1)
F-G	-1908/0	-91.8	-91.8 0.37 (1)	4.52	N-F	0/615	0.10 (1)
G-H	-2021/0	-91.8	-91.8 0.39 (1)	4.41	L-F	0/278	0.08 (1)
H-I	0/41	-91.8	-91.8 0.13 (1)	10.00	L-G	-217/0	0.25 (1)
R-B	-2024/0	0.0	0.0 0.22 (1)	5.94	K-G	-302/0	0.17 (1)
J-H	-2024/0	0.0	0.0 0.22 (1)	5.94	B-Q	0/1829	0.37 (1)
R-Q	0/0	-18.5	-18.5 0.10 (4)	10.00	K-H	0/1829	0.37 (1)
Q-P	0/1580	-18.5	-18.5 0.34 (1)	10.00			
P-O	0/1437	-18.5	-18.5 0.35 (1)	10.00			
O-N	0/1437	-18.5	-18.5 0.35 (1)	10.00			
N-M	0/1437	-18.5	-18.5 0.35 (1)	10.00			
M-L	0/1437	-18.5	-18.5 0.35 (1)	10.00			
L-K	0/1580	-18.5	-18.5 0.34 (1)	10.00			
K-J	0/0	-18.5	-18.5 0.10 (4)	10.00			

TOTAL WEIGHT = 5 X 173 = 867 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = L/999 (0.08)
ALLOWABLE DEFL.(TL) = L/360 (1.17)
CALCULATED VERT. DEFL.(TL) = L/999 (0.17)

OSI: TC=0.74/1.00 (D-E:1), BC=0.35/1.00 (L-N:1), WB=0.58/1.00 (E-N:1), SSI=0.33/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354 1887 788 1987 1858

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (H) (INPUT = 0.90)


JSI METAL = 0.46 (O) (INPUT = 1.00)



Structural component only
DWG# T-2007136

JOB NAME 408168	TRUSS NAME T8	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:57 2020 Page 1
ID:DMCubINVR8TstFoa31v6l_zns11-bLq8j7MyDTz8T87JNyh3A_Cc6BLQ307A4vTQzNBRC
Scale = 1/8" = 1'-0"

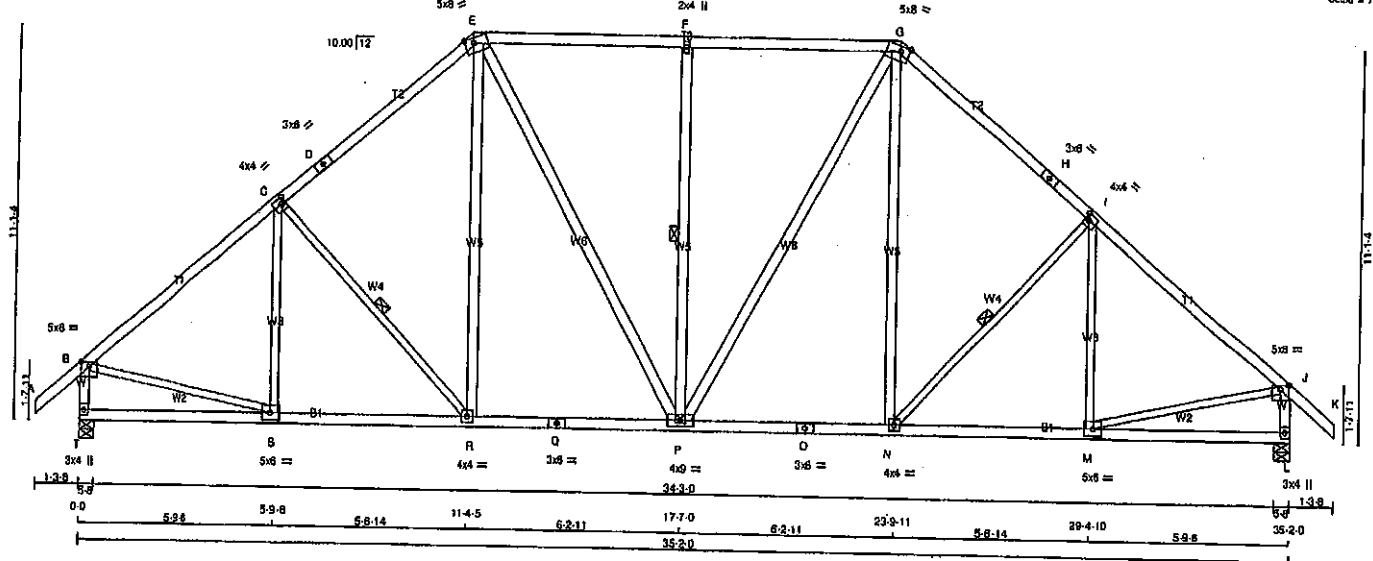

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DRY
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2
J - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x4	DRY	No.2
S - C	2x3	DRY	No.2
C - R	2x3	DRY	No.2
N - I	2x3	DRY	No.2
M - J	2x3	DRY	No.2
B - S	2x3	DRY	No.2
M - J	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.50 3.00
C	TMVW-t	MT20	4.0	4.0	2.00 1.25
D	TS-t	MT20	3.0	6.0	
E	TTVW-m	MT20	5.0	6.0	Edge 3.00
F	TMVW-w	MT20	2.0	4.0	
G	TTVW-m	MT20	5.0	6.0	Edge 3.00
H	TS-t	MT20	3.0	6.0	
I	TMVW-t	MT20	4.0	4.0	2.00 1.25
J	TMVW-p	MT20	5.0	6.0	1.50 3.00
L	BMV1-p	MT20	3.0	4.0	
M	BMVW-t	MT20	5.0	6.0	
N	BMVW-t	MT20	4.0	4.0	
O	BS-t	MT20	3.0	6.0	
P	BMVW-w	MT20	4.0	9.0	
Q	BS-t	MT20	3.0	6.0	
R	BMVW-t	MT20	4.0	4.0	
S	BMVW-t	MT20	5.0	6.0	
T	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	RECORD BRG IN-SX			
T	2066 0	2066 0	0	5-8	5-8		
L	2066 0	2066 0	0	5-8	5-8		

UNFACTORED REACTIONS							
JT	1ST LCASE COMBINED	MAX. MIN. SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
T	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L
 BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.27 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.
 1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-R, F-P, I-N.
 END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	LC1 MAX (LC)	MAX. UNBRACED LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH FR-TO	LC1 MAX (LC)	MAX. UNBRACED LENGTH FR-TO
FR-TO					FR-TO				
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	S-C	-245 / 10	0.17 (1)		
B-C	-2039 / 0	-91.8	-91.8 0.50 (1)	4.27	C-R	-314 / 0	0.15 (1)		
C-D	-1844 / 0	-91.8	-91.8 0.48 (1)	4.47	R-E	0 / 338	0.05 (1)		
D-E	-1844 / 0	-91.8	-91.8 0.48 (1)	4.47	E-P	0 / 469	0.08 (1)		
E-F	-1821 / 0	-91.8	-91.8 0.50 (1)	4.60	P-F	-699 / 0	0.45 (1)		
F-G	-1821 / 0	-91.8	-91.8 0.50 (1)	4.47	G-H	0 / 469	0.08 (1)		
G-H	-1844 / 0	-91.8	-91.8 0.48 (1)	4.47	H-I	0 / 338	0.05 (1)		
H-I	-1844 / 0	-91.8	-91.8 0.48 (1)	4.47	I-N	-314 / 0	0.15 (1)		
I-J	-2039 / 0	-91.8	-91.8 0.50 (1)	4.27	M-I	-245 / 10	0.17 (1)		
J-K	0 / 41	-91.8	-91.8 0.13 (1)	10.00	B-S	0 / 1637	0.37 (1)		
T-B	-2021 / 0	0.0	0.0 0.21 (1)	5.94	M-J	0 / 1637	0.37 (1)		
L-J	-2021 / 0	0.0	0.0 0.21 (1)	5.94					
T-S	0 / 0	-18.5	-18.5 0.14 (4)	10.00					
S-R	0 / 1597	-18.5	-18.5 0.33 (1)	10.00					
R-Q	0 / 1387	-18.5	-18.5 0.30 (1)	10.00					
Q-P	0 / 1387	-18.5	-18.5 0.30 (1)	10.00					
P-O	0 / 1387	-18.5	-18.5 0.30 (1)	10.00					
O-N	0 / 1387	-18.5	-18.5 0.30 (1)	10.00					
N-M	0 / 1597	-18.5	-18.5 0.33 (1)	10.00					
M-L	0 / 0	-18.5	-18.5 0.14 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBCC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2018 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
 CALCULATED VERT. DEFL.(LL) = L/999 (0.07)
 ALLOWABLE DEFL.(TL) = L/360 (1.17)
 CALCULATED VERT. DEFL.(TL) = L/999 (0.14)

CSI: TC=0.50/1.00 (E-F:1), BC=0.33/1.00 (M-N:1), WB=0.45/1.00 (F-P:1), SS=0.28/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.89 (J) (INPUT = 0.90)
 JSI METAL=0.47 (C) (INPUT = 1.00)

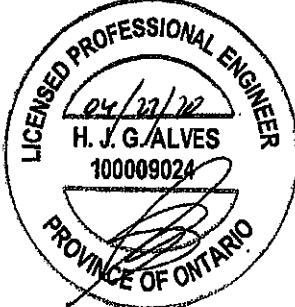

Structural component only
 DWG# T-2007137

JOB NAME 408168	TRUSS NAME T9	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:34:58 2020 Page 1 ID:DMCubINVR6TstFoe31vbl_zns1l-3XOUwSNa_n5755hBISUuEGID_0Uq4EHYDqpS?tzNBRB			

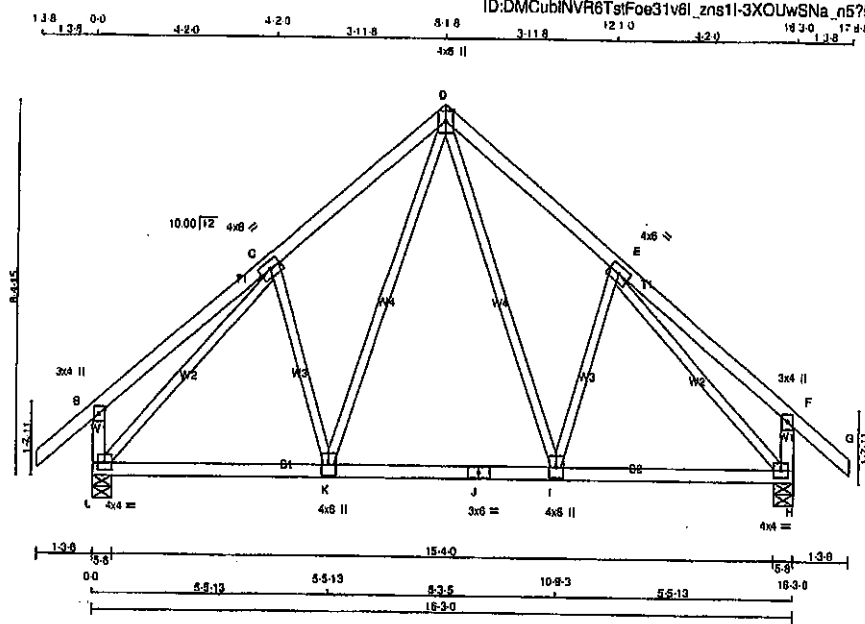

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
A - D	2x4	DRY No.2
D - G	2x4	DRY No.2
L - B	2x4	DRY No.2
H - F	2x4	DRY No.2
L - J	2x4	DRY No.2
J - H	2x4	DRY No.2

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV-p	MT20	3.0	4.0		
C TMWV-1	MT20	4.0	8.0		
D TTMW-p	MT20	4.0	8.0		
E TMWV-1	MT20	4.0	8.0		
F TMV-p	MT20	3.0	4.0		
H BMWV-1	MT20	4.0	8.0		
I BMWV-1	MT20	4.0	8.0		
J BS-1	MT20	3.0	8.0		
K BMWV-1	MT20	4.0	8.0		
L BMWV-1	MT20	4.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	HORZ	DOWN	HORZ
L 1023	0	1023	0
H 1023	0	1023	0

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW
L 721	487 / 0	0 / 0
H 721	487 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	UNBRACED LENGTH (FT)
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	D-I	0 / 330	0.07 (1)
B-C	0 / 28	-91.8	-91.8 0.24 (1)	10.00	I-E	-216 / 0	0.09 (1)
C-D	-745 / 0	-91.8	-91.8 0.19 (1)	6.25	K-D	0 / 330	0.07 (1)
D-E	-743 / 0	-91.8	-91.8 0.19 (1)	6.25	C-K	-216 / 0	0.09 (1)
E-F	0 / 28	-91.8	-91.8 0.24 (1)	10.00	L-C	-943 / 0	0.81 (1)
F-G	0 / 41	-91.8	-91.8 0.13 (1)	10.00	E-H	-943 / 0	0.81 (1)
L-B	-287 / 0	0.0	0.0 0.03 (1)	7.81			
H-F	-287 / 0	0.0	0.0 0.03 (1)	7.81			
L-K	0 / 616	-18.5	-18.5 0.17 (4)	10.00			
K-J	0 / 449	-18.5	-18.5 0.16 (4)	10.00			
J-I	0 / 449	-18.5	-18.5 0.16 (4)	10.00			
I-H	0 / 616	-18.5	-18.5 0.17 (4)	10.00			

TOTAL WEIGHT = 8 X 80 = 481 LB

(M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2010
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.24/1.00 (B-C:1), BC=0.17/1.00 (H-I:4), WB=0.61/1.00 (C-L:1), SS=0.14/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.76 (C) (INPUT = 0.90)
JSI METAL = 0.25 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007138

JOB NAME 408168	TRUSS NAME G9	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

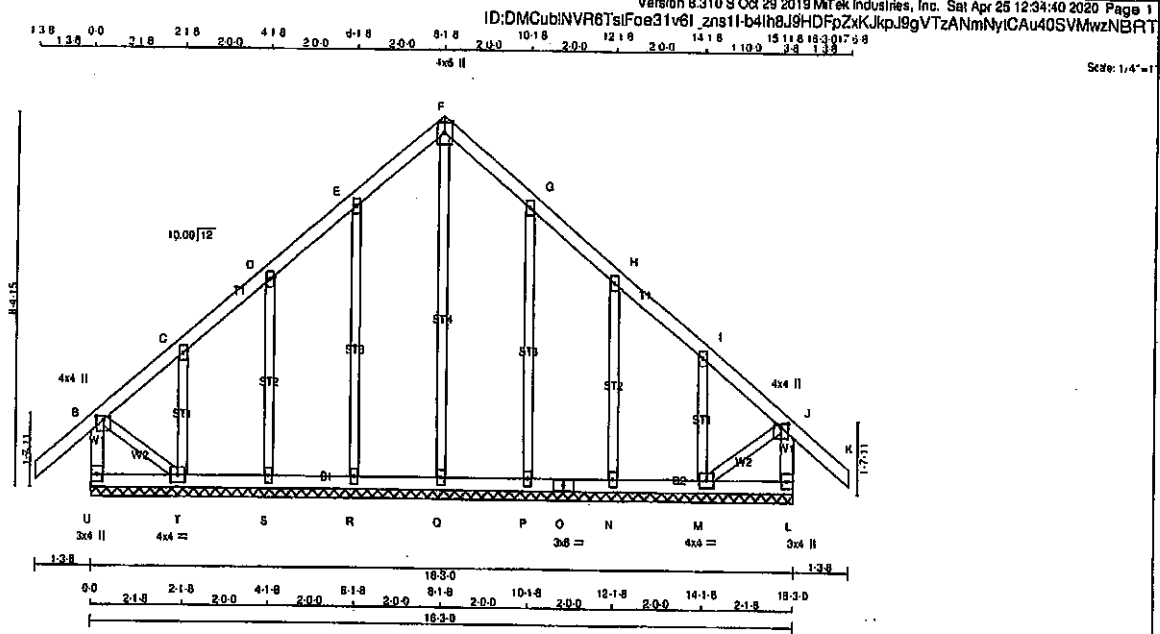

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - F	2x4	DRY	No.2	SPF
F - K	2x4	DRY	No.2	SPF
U - B	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
U - O	2x4	DRY	No.2	SPF
O - L	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

ALL GABLE WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMW+p	MT20	4.0	4.0	1.00	2.00
C, D, E, G, H, I					
C TMW+w	MT20	2.0	4.0		
F TTW+p	MT20	4.0	6.0	Edge	
J TMW+p	MT20	4.0	4.0	1.00	2.00
L BMW1+p	MT20	3.0	4.0		
M BMW1+1	MT20	4.0	4.0		
N, P, Q, R, S					
N BMW1+w	MT20	2.0	4.0		
O BS4	MT20	3.0	6.0		
T BMW1+1	MT20	4.0	4.0		
U BMW1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LCI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LCI (LC)	UNBRACED LENGTH (FT)
FR-TO				FR-TO			
A-B	0/41	-91.8	-91.8 0.13 (1)	Q-F	-124/0	0.17 (1)	
B-C	-28/0	-91.8	-91.8 0.05 (1)	R-E	-210/0	0.16 (1)	
C-D	-38/0	-91.8	-91.8 0.05 (1)	S-D	-169/0	0.08 (1)	
D-E	-24/0	-91.8	-91.8 0.05 (1)	T-C	-205/0	0.04 (1)	
E-F	-38/0	-91.8	-91.8 0.05 (1)	P-G	-210/0	0.16 (1)	
F-G	-38/0	-91.8	-91.8 0.05 (1)	N-H	-169/0	0.08 (1)	
G-H	-24/0	-91.8	-91.8 0.05 (1)	M-I	-205/0	0.04 (1)	
H-I	-38/0	-91.8	-91.8 0.05 (1)	B-T	0/37	0.01 (1)	
I-J	-28/0	-91.8	-91.8 0.05 (1)	M-J	0/37	0.01 (1)	
J-K	0/41	-91.8	-91.8 0.13 (1)				
U-B	-248/0	0.0	0.0 0.03 (1)				
L-J	-248/0	0.0	0.0 0.03 (1)				
U-T	0/0	-18.5	-18.5 0.02 (4)				
T-S	0/25	-18.5	-18.5 0.02 (4)				
S-R	0/21	-18.5	-18.5 0.02 (4)				
R-Q	0/18	-18.5	-18.5 0.02 (4)				
Q-P	0/18	-18.5	-18.5 0.02 (4)				
P-O	0/21	-18.5	-18.5 0.02 (4)				
O-N	0/21	-18.5	-18.5 0.02 (4)				
N-M	0/25	-18.5	-18.5 0.02 (4)				
M-L	0/0	-18.5	-18.5 0.02 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH: LL = 25.6 PSF
DL = 6.0 PSF

BOT CH: LL = 0.0 PSF
DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCG 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (A-B:1), BC=0.02/1.00 (M-N:4), WB=0.17/1.00 (F-C:1), SI=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.52 (T) (INPUT = 0.80)
JSI METAL = 0.11 (G) (INPUT = 1.00)

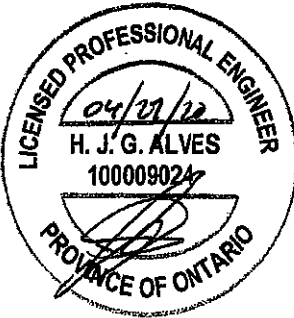

Structural component only
DWG# T-2007123

JOB NAME 408168	TRUSS NAME T10	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:34:59 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-Xjys8oOCi4DsIFFNqo?7nUGOUQrOpqnhSUZ?XJzNBRA

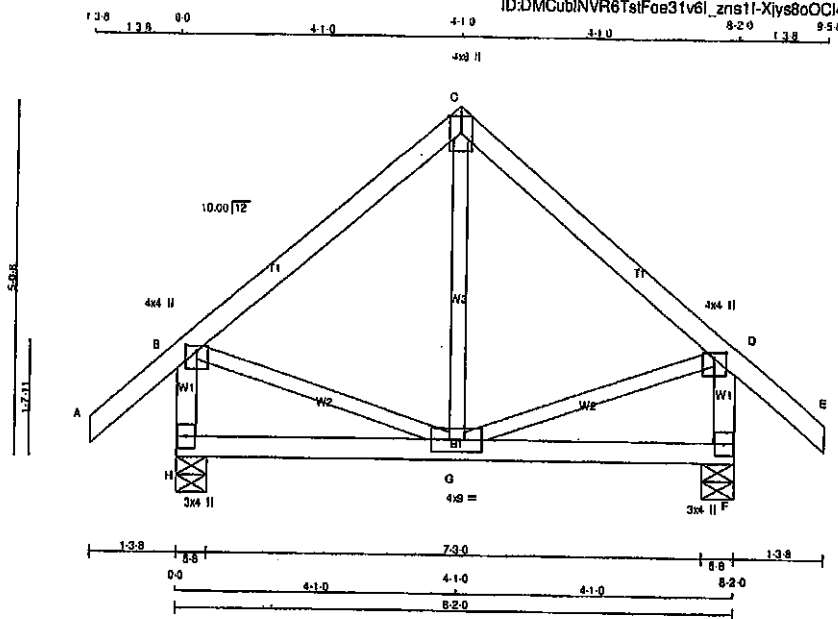

Scale = 1/100

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - D	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW+p	MT20	4.0	6.0	Edge	
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVWV-t	MT20	4.0	9.0		
H	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
H	577	0	577	0	5-8
F	577	0	577	0	5-8

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	406	280 / 0	0 / 0	0 / 0	0 / 0	128 / 0	0 / 0
F	406	280 / 0	0 / 0	0 / 0	0 / 0	128 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0 / 41	-91.8 -91.8	0.13 (1)	G-C	-37 / 57	0.02 (4)	
B-C	-264 / 0	-91.8 -91.8	0.20 (1)	B-G	0 / 213	0.05 (1)	
C-D	-264 / 0	-91.8 -91.8	0.20 (1)	G-D	0 / 213	0.05 (1)	
D-E	0 / 41	-91.8 -91.8	0.13 (1)				
H-B	-548 / 0	0.0 0.0	0.06 (1)				
F-D	-548 / 0	0.0 0.0	0.06 (1)				
H-G	0 / 0	-18.5 -18.5	0.09 (4)				
G-F	0 / 0	-18.5 -18.5	0.09 (4)				

TOTAL WEIGHT = 38 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. HAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.27")
CALCULATED VERT. DEFL.(LL) = L/899 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.27")
CALCULATED VERT. DEFL.(TL) = L/899 (0.01")

CSI: TO=0.20/1.00 (B-C:1), BC=0.09/1.00 (F-G:4), WB=0.05/1.00 (D-G:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1967 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.48 (D) (INPUT = 0.90)
JSI METAL= 0.12 (D) (INPUT = 1.00)

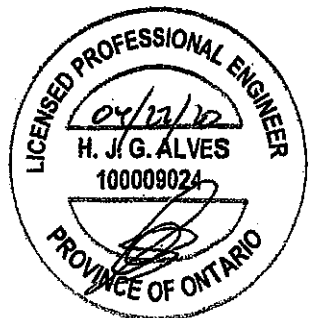


Structural component only
DWG# T-2007139

JOB NAME 408168	TRUSS NAME G10	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 12:34:41 2020 Page 1
ID:DMCubINVR6TsiFos31v6I_zns11-3Gs3MeAv_YyQYUlwN0gv2hWL7A/CchL2JgC3vMzNBRS

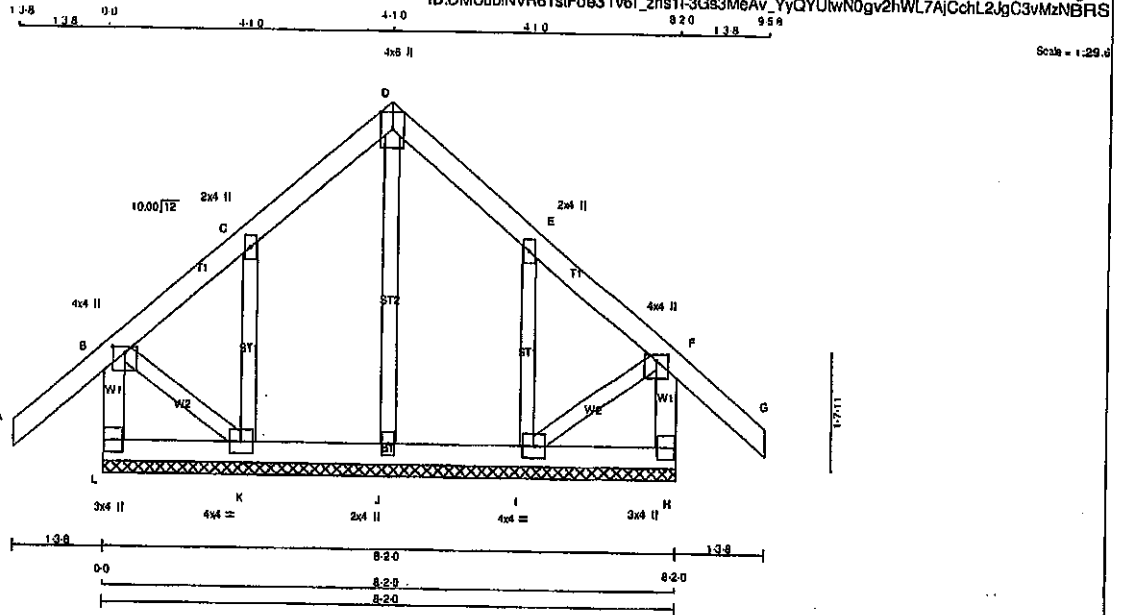

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
L - B	2x4	DRY	No.2
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TMVW+p	MT20	2.0	4.0		
D	TTW+p	MT20	4.0	6.0	Edge	
E	TMVW+p	MT20	2.0	4.0		
F	TMVW+p	MT20	4.0	4.0	1.00	2.00
H	BMV1+p	MT20	3.0	4.0		
I	BMVW1+p	MT20	4.0	4.0		
J	BMV1+p	MT20	2.0	4.0		
K	BMVW1+p	MT20	4.0	4.0		
L	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM	TO	FR-TO			
L-B	-224 / 0	0.0	0.02 (1)	7.81	J-D	-126 / 0	0.05 (1)
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	K-C	-227 / 0	0.04 (1)
B-C	-11 / 0	-91.8	-91.8 0.09 (1)	8.25	I-E	-227 / 0	0.04 (1)
C-D	-31 / 0	-91.8	-91.8 0.08 (1)	6.25	B-K	0 / 24	0.01 (1)
D-E	-31 / 0	-91.8	-91.8 0.08 (1)	6.25	I-F	0 / 24	0.01 (1)
E-F	-11 / 0	-91.8	-91.8 0.13 (1)	10.00			
F-G	0 / 41	-91.8	-91.8 0.13 (1)	10.00			
H-F	-224 / 0	0.0	0.02 (1)	7.81			
L-K	0 / 0	-18.5	-18.5 0.02 (4)	10.00			
K-J	0 / 13	-18.5	-18.5 0.02 (4)	10.00			
J-I	0 / 13	-18.5	-18.5 0.02 (4)	10.00			
I-H	0 / 0	-18.5	-18.5 0.02 (4)	10.00			

TOTAL WEIGHT = 40 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TO=0.13/1.00 (A-B:1), BC=0.02/1.00 (J-K:4), WB=0.05/1.00 (D-J:1), SSI=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	818	354	1687
		788	1987
			1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (C) (INPUT = 0.90)
JSI METAL= 0.12 (C) (INPUT = 1.00)

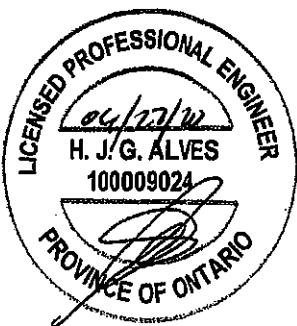


Structural component only
DWG# T-2007124

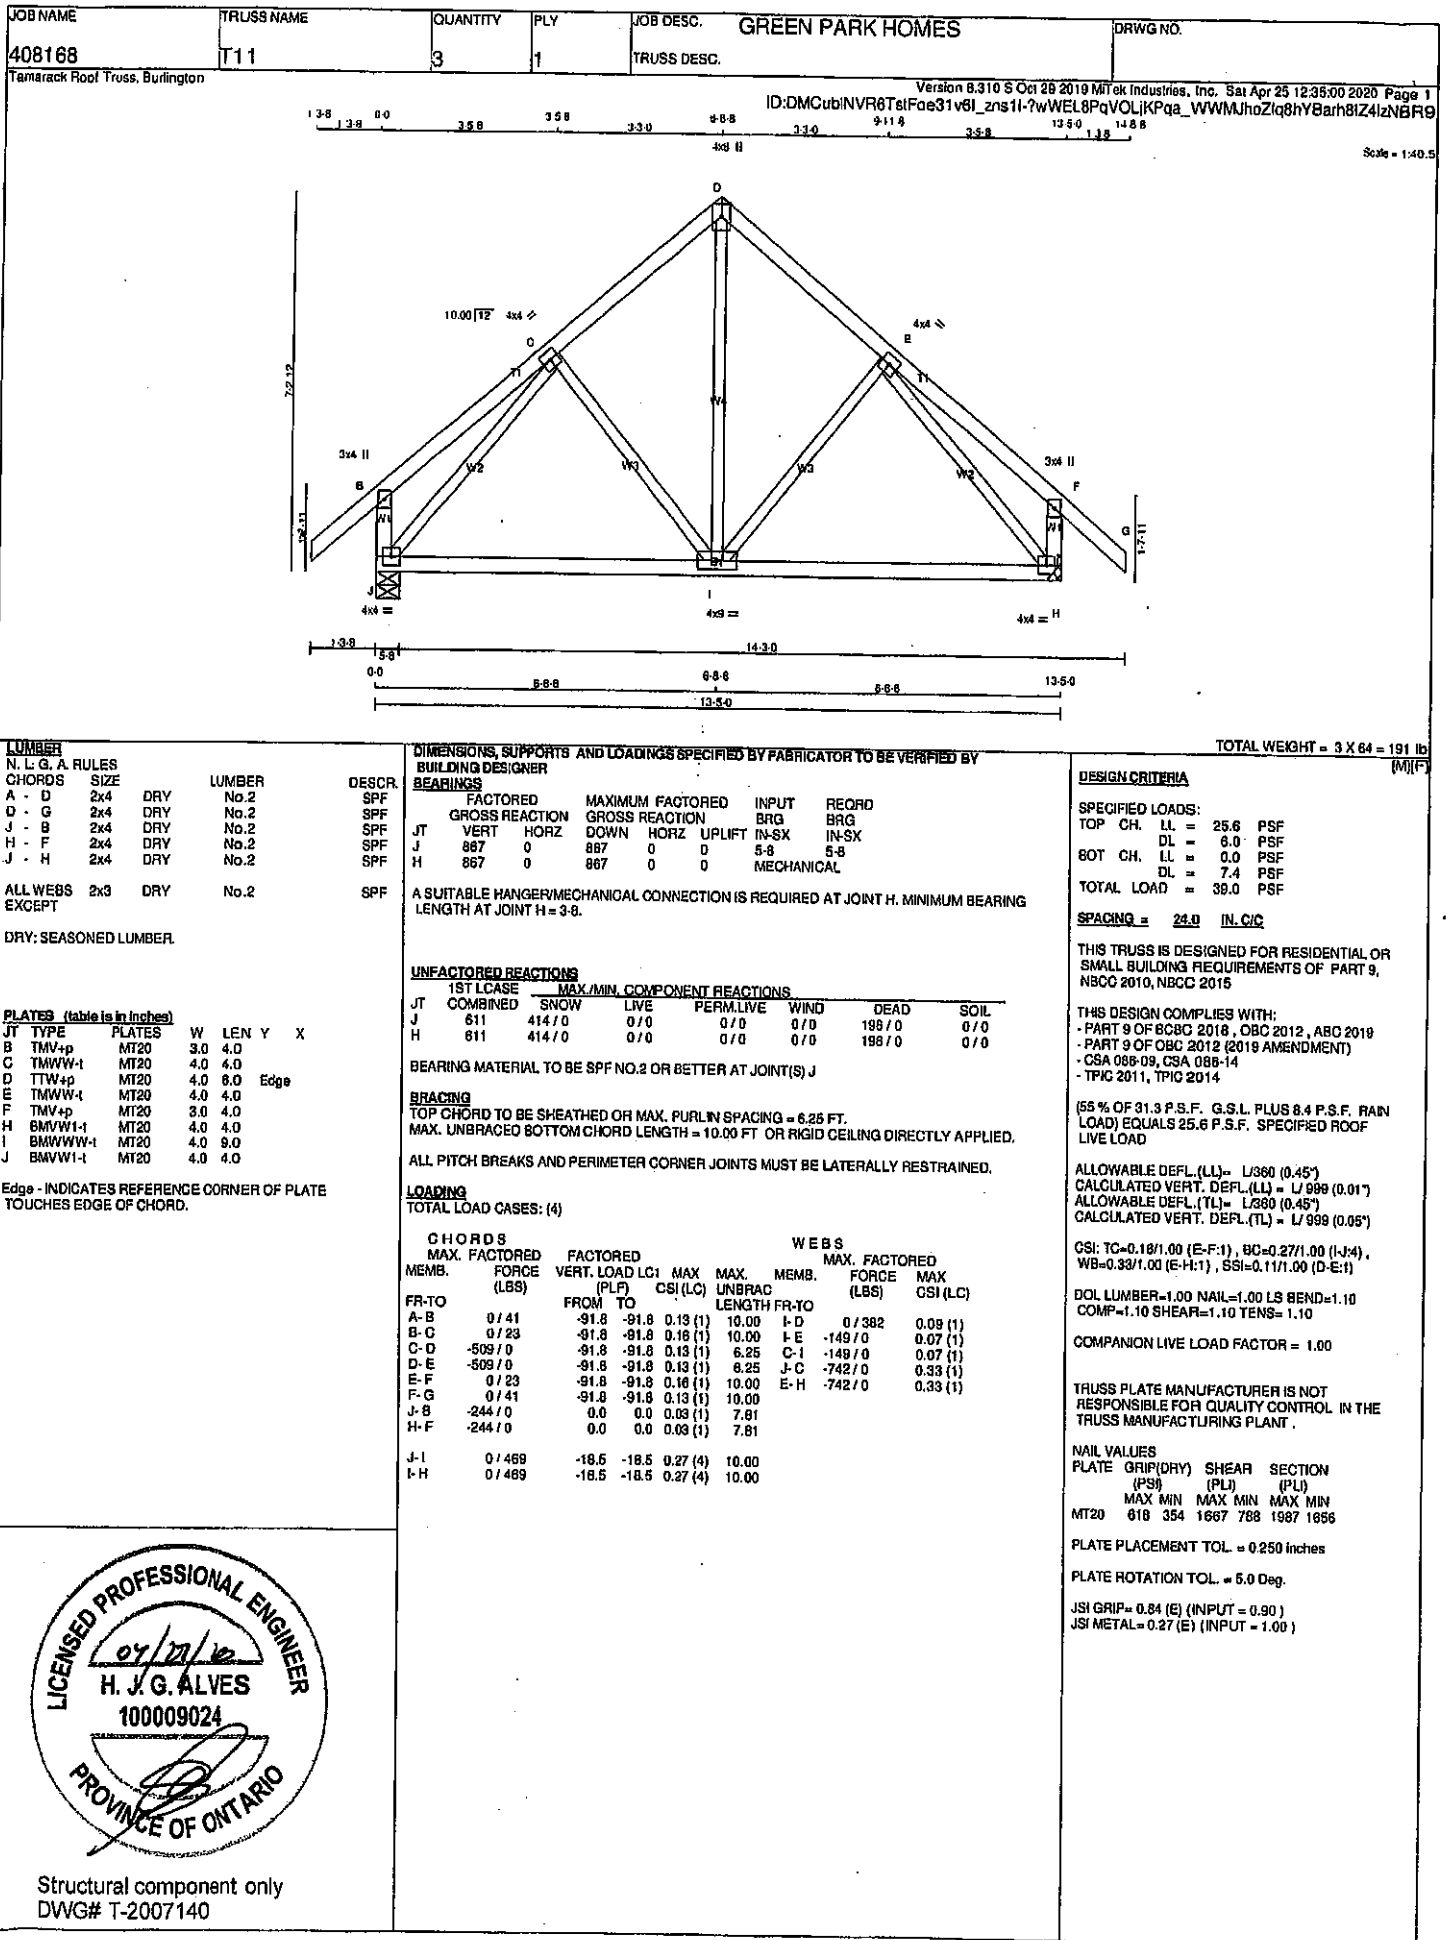

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	G11	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 28 2019 MITek Industries, Inc. Sat Apr 25 12:34:42 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns1I-XSQRZ_BXIs4GAeS6xk88au3WtZ3HL6XBYKxcRozNBRR

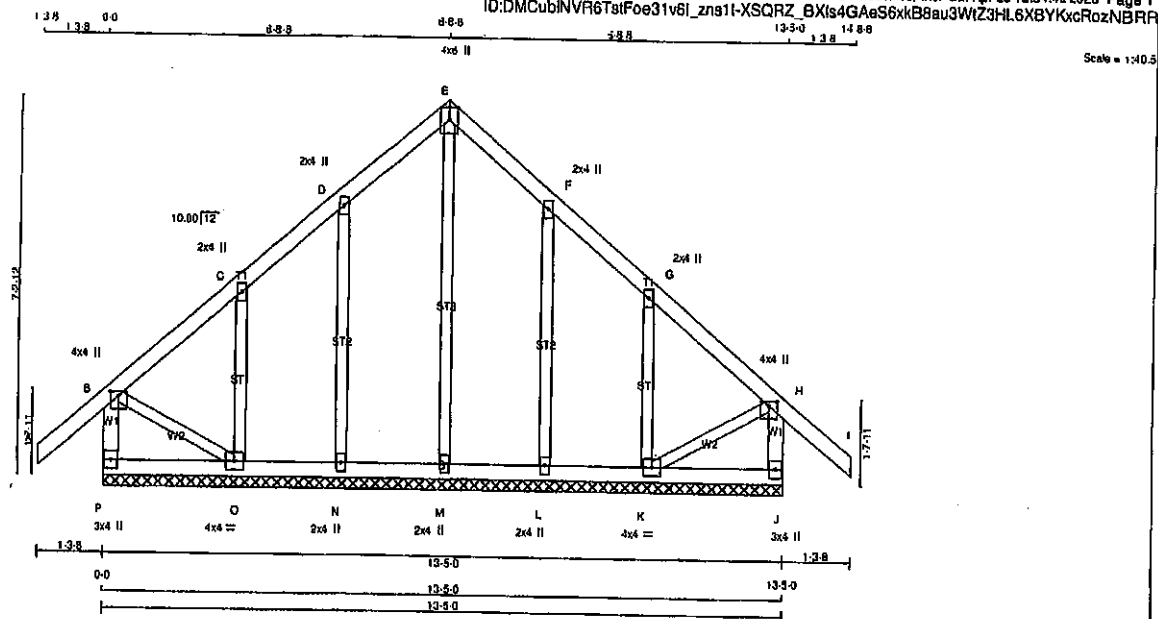

Scale = 1/4"=1'-0"

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS	2x4	DRY	No. 2
P - B	2x4	DRY	No. 2
A - E	2x4	DRY	No. 2
E - I	2x4	DRY	No. 2
J - H	2x4	DRY	No. 2
P - J	2x4	DRY	No. 2
ALL WEBS	2x3	DRY	No. 2
ALL GABLE WEBS	2x3	DRY	No. 2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C, D, F, G					
C TMVW+p	MT20	2.0	4.0		
E TTW+p	MT20	4.0	6.0	Edge	
H TMVW+p	MT20	4.0	4.0	1.00	2.00
J BMV1+p	MT20	3.0	4.0		
K BMVW1-i	MT20	4.0	4.0		
L, M, N					
L BMV1+w	MT20	2.0	4.0		
O BMVW1-i	MT20	4.0	4.0		
P BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)	
FR-TO		FROM	TO	FR-TO			
P-B	-283/0	0.0	0.0	0.03 (1)	7.81	M-E	-128/0
A-B	0/41	-91.8	-91.8	0.08 (1)	10.00	N-D	-190/0
B-C	-24/0	-91.8	-91.8	0.08 (1)	6.25	O-C	-239/0
C-D	-38/0	-91.8	-91.8	0.08 (1)	6.25	L-F	-190/0
D-E	-35/0	-91.8	-91.8	0.05 (1)	6.25	K-G	-239/0
E-F	-35/0	-91.8	-91.8	0.05 (1)	6.25	B-O	0/32
F-G	-38/0	-91.8	-91.8	0.08 (1)	6.25	K-H	0/32
G-H	-24/0	-91.8	-91.8	0.08 (1)	6.25		
H-I	0/41	-91.8	-91.8	0.13 (1)	10.00		
J-H	-283/0	0.0	0.0	0.03 (1)	7.81		
P-O	0/0	-18.5	-18.5	0.03 (4)	10.00		
O-N	0/22	-18.5	-18.5	0.03 (4)	10.00		
N-M	0/19	-18.5	-18.5	0.02 (4)	10.00		
M-L	0/19	-18.5	-18.5	0.02 (4)	10.00		
L-K	0/22	-18.5	-18.5	0.03 (4)	10.00		
K-J	0/0	-18.5	-18.5	0.03 (4)	10.00		

TOTAL WEIGHT = 65 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=		39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS1: TC=0.13/1.00 (H-I), BC=0.03/1.00 (K-L), WB=0.11/1.00 (E-M), SSI=0.08/1.00 (G-H)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1887
	618	354	1887

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.20 (5) (INPUT = 0.90)
JSI METAL= 0.13 (3) (INPUT = 1.00)




Structural component only
DWG# T-2007125

JOB NAME 408168	TRUSS NAME T12	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 9.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 12:35:01 2020 Page 1
ID:DMCubINVR6TsIFoe31v6I_zns11-T63dYUPSGITayZPmYD1bsvLIXEW1HhI_vn26CzNBR9

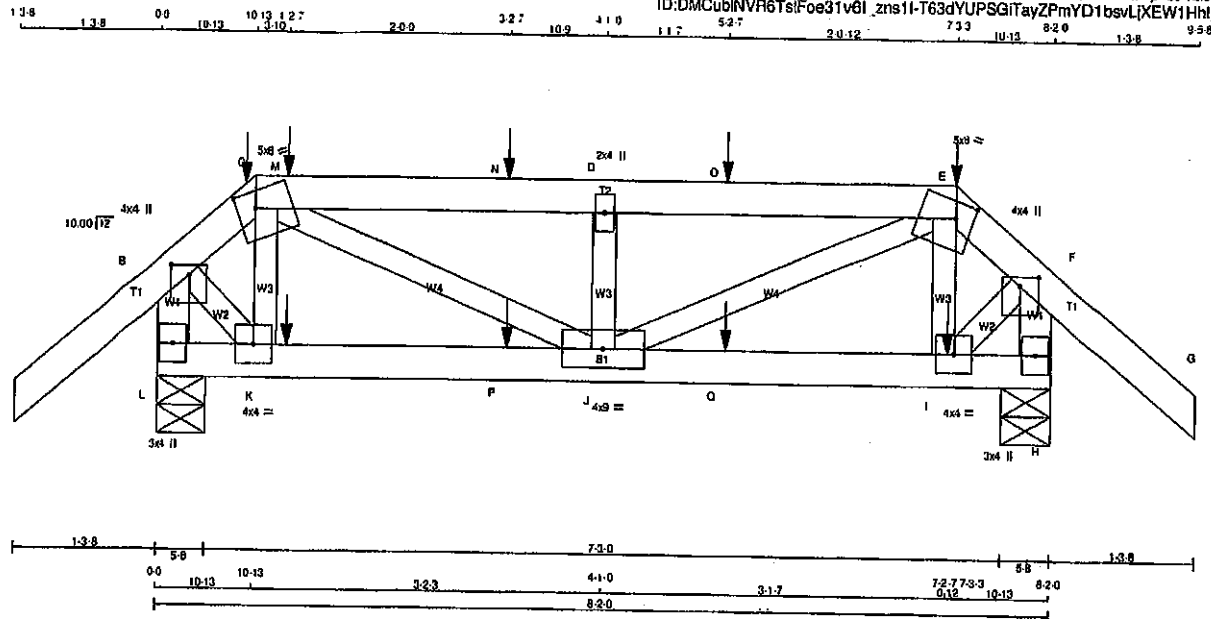

Scale = 1:16.8

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
L - B	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
L - H	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW+p	MT20	4.0	4.0 1.00 2.00
C	TTWW-m	MT20	5.0	8.0 1.75 2.00
D	TMVW-w	MT20	2.0	4.0
E	TTWW-m	MT20	5.0	8.0 1.75 2.00
F	TMVW+p	MT20	4.0	4.0 1.00 2.00
H	BMV1+p	MT20	3.0	4.0
I	BMVW-1	MT20	4.0	4.0
J	BMVW-1	MT20	4.0	9.0
K	BMVW-1	MT20	4.0	4.0
L	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	BRG	IN-SX	BRG	IN-SX
L	913	0	913	0	0	5-8	5-8	5-8	5-8
H	911	0	911	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM	LIVE	WIND	DEAD	SOIL	
L	642	442 / 0	0 / 0	0 / 0	0 / 0	0 / 0	199 / 0	0 / 0	
H	641	437 / 0	0 / 0	0 / 0	0 / 0	0 / 0	204 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.82 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD LC1	MAX	CS1 (LC)	UNBRAC LENGTH FR-TO	MEMB.	FORCE (LBS)	MAX	CS1 (LC)
FR-TO						FR-TO			
A-B	0 / 41	-91.8	-91.8	0.14 (1)	10.00	J-D	-487 / 0	0.08 (1)	
B-C	-631 / 0	-91.8	-91.8	0.14 (1)	8.25	K-C	-158 / 0	0.02 (1)	
C-M	-1054 / 0	-91.8	-91.8	0.23 (1)	5.82	C-J	0 / 700	0.17 (1)	
M-N	-1054 / 0	-91.8	-91.8	0.23 (1)	5.82	B-K	0 / 525	0.13 (1)	
N-D	-1054 / 0	-91.8	-91.8	0.23 (1)	5.82	I-E	-149 / 0	0.02 (1)	
O-O	-1054 / 0	-91.8	-91.8	0.23 (1)	5.82	J-E	0 / 898	0.17 (1)	
O-E	-1054 / 0	-91.8	-91.8	0.23 (1)	5.82	I-F	0 / 526	0.13 (1)	
E-F	-632 / 0	-91.8	-91.8	0.14 (1)	8.25				
F-G	0 / 41	-91.8	-91.8	0.14 (1)	10.00				
L-B	-936 / 0	0.0	0.0	0.10 (1)	7.81				
H-F	-937 / 0	0.0	0.0	0.10 (1)	7.81				
L-K	0 / 0	-18.5	-18.5	0.05 (1)	10.00				
K-P	0 / 420	-18.5	-18.5	0.13 (1)	10.00				
P-J	0 / 420	-18.5	-18.5	0.13 (1)	10.00				
J-Q	0 / 421	-18.5	-18.5	0.14 (1)	10.00				
Q-I	0 / 421	-18.5	-18.5	0.14 (1)	10.00				
I-H	0 / 0	-18.5	-18.5	0.05 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	FACE	DIR.	TYPE	HEEL	CONN.
C	10-13	-9	-10	---	FRONT	VERT	---	C1
C	1-2-7	-114	-114	---	BACK	VERT	---	C1
C	10-13	-44	-44	---	FRONT	VERT	---	C1
E	7-3-3	-9	-10	---	FRONT	VERT	---	C1
E	7-3-3	-90	-90	---	BACK	VERT	---	C1
E	7-3-3	-44	-44	---	FRONT	VERT	---	C1
I	7-2-7	-49	-49	---	BACK	VERT	---	C1
K	1-2-7	-49	-49	---	BACK	VERT	---	C1
N	3-2-7	-82	-82	---	BACK	VERT	---	C1
O	5-2-7	-82	-82	---	BACK	VERT	---	C1
P	3-2-7	-49	-49	---	BACK	VERT	---	C1
Q	5-2-7	-49	-49	---	BACK	VERT	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 34 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***
ADDT USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.27")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.27")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CS1: TC=0.23/1.00 (C-D:1), GC=0.14/1.00 (I-J:1), WB=0.17/1.00 (C-J:1), SS1=0.22/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

CONTINUED ON PAGE 2

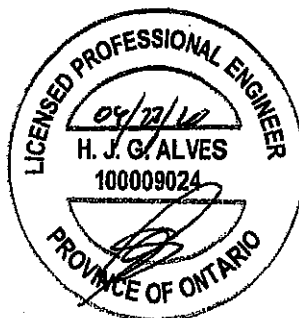

Structural component only
DWG# T-2007141

JOB NAME 408168	TRUSS NAME T13	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamsack Roof Truss, Burlington				Version 8.310 8 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:35:03 2020 Page 1 ID:DMCubINVR8TstFoe31v6l_zns1l-PVBNzARioJlBSZ9ie33xKQvZ1CWYJHN5XDq4zNBR6	
Scale = 1:17.3					

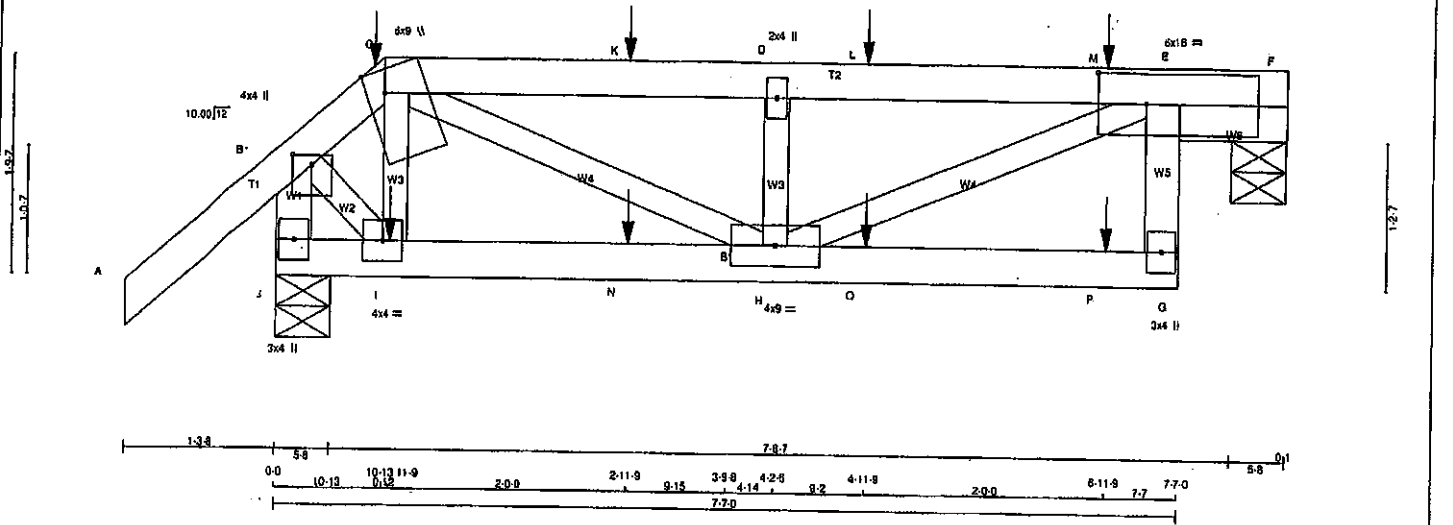

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
G - H	2x4	DRY	No.2
J - B	2x4	DRY	No.2
J - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
C	TTVW+m	MT20	6.0	8.0	Edge 1.75
D	TMVW+w	MT20	2.0	4.0	
E	TMVWW-t	MT20	6.0	16.0	3.00 5.00
G	BMV+p	MT20	3.0	4.0	
H	BMVWV-t	MT20	4.0	9.0	
I	BMVW-t	MT20	4.0	4.0	
J	BMV+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	685	0	0	0
F	HORZ	885	0	5-8	5-8
J	VERT	936	0	0	0
J	HORZ	936	0	5-8	5-8

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): F

UNFACTORED REACTIONS		1ST CASE	MAX MIN. COMPONENT REACTIONS
JT	COMBINED	490	327 / 0
F	SNOW	659	449 / 0
J	LIVE	0	0 / 0
J	PERM. LIVE	0	0 / 0
J	WIND	0	0 / 0
J	DEAD	183	0 / 0
J	SOIL	210	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. FACTORED HORIZ. LOAD (PL)	MAX. FACTORED MOMENT (FT-LB)	WESS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED MOMENT (FT-LB)
FR-TO	FROM TO					FR-TO		
A-B	0 / 41	-91.8	-91.8	0.14 (1)	10.00	F-C	-158 / 0	0.03 (1)
B-C	-856 / 0	-91.8	-91.8	0.14 (1)	8.25	G-I	0 / 548	0.14 (1)
C-K	-1230 / 0	-91.8	-91.8	0.48 (1)	5.09	H-D	-787 / 0	0.12 (1)
K-D	-1230 / 0	-91.8	-91.8	0.48 (1)	5.09	C-H	0 / 887	0.21 (1)
D-L	-1230 / 0	-91.8	-91.8	0.89 (1)	3.58	H-E	0 / 1345	0.33 (1)
L-M	-1230 / 0	-91.8	-91.8	0.89 (1)	3.58			
M-E	-1230 / 0	-91.8	-91.8	0.89 (1)	3.58			
E-F	0 / 0	-91.8	-91.8	0.35 (1)	10.00			
G-E	0 / 83	0.0	0.0	0.02 (4)	10.00			
J-B	-986 / 0	0.0	0.0	0.11 (1)	7.81			
J-I	0 / 0	-18.5	-18.5	0.08 (1)	10.00			
I-N	0 / 438	-18.5	-18.5	0.14 (1)	10.00			
N-H	0 / 438	-18.5	-18.5	0.14 (1)	10.00			
H-O	0 / 0	-18.5	-18.5	0.09 (1)	10.00			
O-P	0 / 0	-18.5	-18.5	0.09 (1)	10.00			
P-G	0 / 0	-18.5	-18.5	0.09 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)		LOC.	LOC.	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
JT	LOC.	LOC.	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.	
C	10-13	-9	-10	---	FRONT	VERT	DEAD	---	C1	
C	10-13	-90	-90	---	FRONT	VERT	TOTAL	---	C1	
C	10-13	-44	-44	---	FRONT	VERT	SNOW	---	C1	
I	11-9	-48	-48	---	FRONT	VERT	TOTAL	---	C1	
K	2-11-9	-82	-82	---	FRONT	VERT	TOTAL	---	C1	
L	4-11-9	-82	-82	---	FRONT	VERT	TOTAL	---	C1	
M	8-11-9	-82	-82	---	FRONT	VERT	TOTAL	---	C1	
N	2-11-9	-49	-49	---	FRONT	VERT	TOTAL	---	C1	
O	4-11-9	-48	-48	---	FRONT	VERT	TOTAL	---	C1	
P	8-11-9	-53	-53	---	FRONT	VERT	TOTAL	---	C1	

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.25")
CALCULATED VERT. DEFL.(LL) = L/989 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (0.25")
CALCULATED VERT. DEFL.(TL) = L/688 (0.13")

CSL TC=0.89/1.00 (D-E:1), BC=0.14/1.00 (H-I:1),
WB=0.33/1.00 (E-H:1), SS=0.42/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PL)
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.79 (C) (INPUT = 0.90)
JSI METAL = 0.30 (H) (INPUT = 1.00)




Structural component only
DWG# T-2007142

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408169	T20	1	2	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:24 2020 Page 1
ID:K?TPdhg0np1q1YdbWfOFzIdeG-iBjtasn1sB7_Budbz0zKub4B6zN_xr0MZbH0gzNBDf

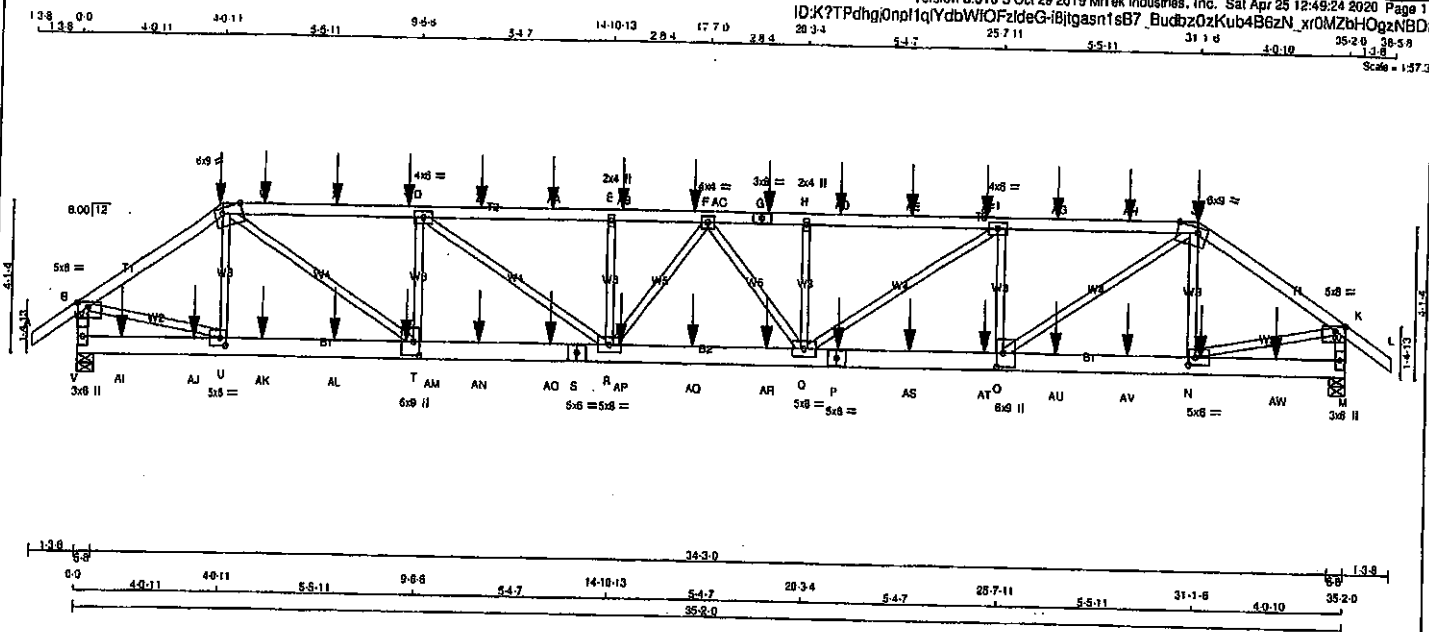

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF		
C - G	2x4 DRY	No.2	SPF		
G - J	2x4 DRY	No.2	SPF		
J - L	2x4 DRY	No.2	SPF		
V - B	2x4 DRY	No.2	SPF		
M - K	2x4 DRY	No.2	SPF		
V - S	2x6 DRY	No.2	SPF		
S - P	2x6 DRY	No.2	SPF		
P - M	2x6 DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE(61.0)
C - G	12	SIDE(61.0)
G - J	12	SIDE(61.0)
J - L	12	SIDE(61.0)
V - B	12	TOP
M - K	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
V - S	12	SIDE(183.1)
S - P	12	SIDE(183.1)
P - M	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	3342	3342	0	0
V	3342	3342	0	0
M	3393	3393	0	0

UNFACTORED REACTIONS

1ST CASE	MAX/MIN COMPONENT REACTIONS						
JT COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
V	2363	1585 / 0	0 / 0	0 / 0	808 / 0	0 / 0	
M	2397	1585 / 0	0 / 0	0 / 0	812 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED MEMB. FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO		
A-B	0 / 35	-91.8	-91.8 0.07 (1)	U-C	-598 / 0	0.08 (1)
B-C	-3951 / 0	-91.8	-91.8 0.22 (1)	C-T	0 / 3530	0.44 (1)
C-W	-6186 / 0	-91.8	-91.8 0.61 (1)	T-D	-1829 / 0	0.23 (1)
W-X	-6186 / 0	-91.8	-91.8 0.61 (1)	D-R	0 / 1802	0.20 (1)
X-Y	-6186 / 0	-91.8	-91.8 0.61 (1)	R-E	-602 / 0	0.08 (1)
Y-D	-6186 / 0	-91.8	-91.8 0.61 (1)	Q-H	-586 / 0	0.08 (1)
D-Z	-7502 / 0	-91.8	-91.8 0.71 (1)	Q-I	0 / 1573	0.19 (1)
Z-AA	-7502 / 0	-91.8	-91.8 0.71 (1)	O-I	-1806 / 0	0.23 (1)
AA-E	-7502 / 0	-91.8	-91.8 0.71 (1)	O-J	0 / 3493	0.43 (1)
E-AB	-7502 / 0	-91.8	-91.8 0.35 (1)	N-J	-816 / 0	0.08 (1)
AB-AC	-7502 / 0	-91.8	-91.8 0.35 (1)	B-U	0 / 3374	0.42 (1)
AC-F	-7502 / 0	-91.8	-91.8 0.35 (1)	N-K	0 / 3439	0.43 (1)
F-G	-7509 / 0	-91.8	-91.8 0.37 (1)	R-F	-179 / 0	0.03 (1)
G-H	-7509 / 0	-91.8	-91.8 0.37 (1)	F-Q	-166 / 0	0.03 (1)
H-AD	-7509 / 0	-91.8	-91.8 0.71 (1)			
AD-AE	-7509 / 0	-91.8	-91.8 0.71 (1)			
AE-AF	-7509 / 0	-91.8	-91.8 0.71 (1)			
AF-I	-7509 / 0	-91.8	-91.8 0.71 (1)			
I-AG	-6217 / 0	-91.8	-91.8 0.61 (1)			
AG-AH	-6217 / 0	-91.8	-91.8 0.61 (1)			
AH-J	-6217 / 0	-91.8	-91.8 0.61 (1)			
J-K	-4025 / 0	-91.8	-91.8 0.22 (1)			
K-L	0 / 35	-91.8	-91.8 0.07 (1)			
V-B	-3298 / 0	0.0	0.0 0.16 (1)			
M-K	-3356 / 0	0.0	0.0 0.19 (1)			
V-AI	0 / 0	-18.5	-18.5 0.05 (4)			
AI-AJ	0 / 0	-18.5	-18.5 0.05 (4)			
AJ-U	0 / 0	-18.5	-18.5 0.05 (4)			
U-AK	0 / 3265	-18.5	-18.5 0.25 (1)			
AK-AL	0 / 3265	-18.5	-18.5 0.25 (1)			
AL-AM	0 / 3265	-18.5	-18.5 0.25 (1)			
AM-T	0 / 3265	-18.5	-18.5 0.25 (1)			
T-AN	0 / 6186	-18.5	-18.5 0.48 (1)			
AN-AO	0 / 6186	-18.5	-18.5 0.48 (1)			
AO-S	0 / 6186	-18.5	-18.5 0.48 (1)			
S-R	0 / 6186	-18.5	-18.5 0.48 (1)			
R-AP	0 / 7606	-18.5	-18.5 0.58 (1)			
AP-AQ	0 / 7606	-18.5	-18.5 0.58 (1)			
AQ-AR	0 / 7606	-18.5	-18.5 0.58 (1)			
AR-Q	0 / 7606	-18.5	-18.5 0.58 (1)			
Q-P	0 / 6217	-18.5	-18.5 0.48 (1)			
P-AS	0 / 6217	-18.5	-18.5 0.48 (1)			

TOTAL WEIGHT = 2 X 160 = 321 B

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPC 2014

65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = L/999 (0.23)
ALLOWABLE DEFL.(TL) = L/360 (1.17)
CALCULATED VERT. DEFL.(TL) = L/984 (0.44)

CSI: TC=0.71/1.00 (D-E:1), BC=0.58/1.00 (Q-R:1), WB=0.44/1.00 (C-T:1), SS=0.23/1.00 (O-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.71 (G) (INPUT = 0.90)
JSI METAL= 0.59 (S) (INPUT = 1.00)



Structural component only
DWG# T-2007145 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T20	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 28 12:49:24 2020 Page 2
ID:K?TPdHg0np1qIYdbWfOFzdeG-i8itqasnt5B7_Budbz0zKub4B6zN_xr0MZbHOqzNBDf

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	8.0	1.50 3.50
C	TTWW-m	MT20	6.0	9.0	Edge 8.25
D	TMVW-t	MT20	4.0	8.0	
E	TMVW-w	MT20	2.0	4.0	
F	TMVW-t	MT20	4.0	4.0	
G	TS-t	MT20	3.0	6.0	
H	TMVW-w	MT20	2.0	4.0	
I	TMVW-t	MT20	4.0	6.0	
J	TTWW-m	MT20	6.0	9.0	Edge 8.25
K	TMVW-p	MT20	5.0	8.0	1.50 3.50
M	BMV1-p	MT20	3.0	6.0	
N	BMVW-t	MT20	5.0	6.0	2.50 2.00
O	BMVW-t	MT20	6.0	9.0	4.50 2.00
P	BS-t	MT20	5.0	6.0	
Q	BMVW-w	MT20	5.0	8.0	
R	BMVW-t	MT20	5.0	8.0	
S	BS-t	MT20	5.0	6.0	
T	BMVW-t	MT20	6.0	9.0	4.50 2.00
U	BMVW-t	MT20	5.0	6.0	2.50 2.00
V	BMV1-p	MT20	3.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	CS1 (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO		LENGTH FR-TO			
AS-AT	0/8217	-18.5	-18.5	0.46 (1)			10.00
AT-O	0/8217	-18.5	-18.5	0.46 (1)			10.00
O-AU	0/3328	-18.5	-18.5	0.26 (1)			10.00
AU-AV	0/3328	-18.5	-18.5	0.26 (1)			10.00
AV-N	0/3328	-18.5	-18.5	0.26 (1)			10.00
N-AW	0/0	-18.5	-18.5	0.04 (4)			10.00
AW-M	0/0	-18.5	-18.5	0.04 (4)			10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-11	-49	-55	---	FRONT	VERT	DEAD	---
C	4-0-11	-254	-254	---	FRONT	VERT	SNOW	---
G	19-2-12	-110	-110	---	BACK	VERT	TOTAL	---
J	31-1-8	-49	-55	---	FRONT	VERT	DEAD	---
J	31-1-8	-117	-117	---	BACK	VERT	TOTAL	---
J	31-1-8	-254	-254	---	FRONT	VERT	SNOW	---
N	31-2-12	-26	-26	---	BACK	VERT	TOTAL	---
P	21-2-12	-26	-26	---	BACK	VERT	TOTAL	---
W	5-2-12	-110	-110	---	BACK	VERT	TOTAL	---
X	7-2-12	-110	-110	---	BACK	VERT	TOTAL	---
Y	9-2-12	-110	-110	---	BACK	VERT	TOTAL	---
Z	11-2-12	-110	-110	---	BACK	VERT	TOTAL	---
AA	13-2-12	-110	-110	---	BACK	VERT	TOTAL	---
AB	15-2-12	-110	-110	---	BACK	VERT	TOTAL	---
AC	17-2-12	-110	-110	---	BACK	VERT	TOTAL	---
AD	21-2-12	-110	-110	---	BACK	VERT	TOTAL	---
AE	23-2-12	-110	-110	---	BACK	VERT	TOTAL	---
AF	25-2-12	-110	-110	---	BACK	VERT	TOTAL	---
AG	27-2-12	-110	-110	---	BACK	VERT	TOTAL	---
AH	29-2-12	-110	-110	---	BACK	VERT	TOTAL	---
AI	1-2-12	-26	-26	---	BACK	VERT	TOTAL	---
AJ	3-2-12	-26	-26	---	BACK	VERT	TOTAL	---
AK	5-2-12	-26	-26	---	BACK	VERT	TOTAL	---
AL	7-2-12	-26	-26	---	BACK	VERT	TOTAL	---
AM	9-2-12	-26	-26	---	BACK	VERT	TOTAL	---
AN	11-2-12	-26	-26	---	BACK	VERT	TOTAL	---
AO	13-2-12	-26	-26	---	BACK	VERT	TOTAL	---
AP	15-2-12	-26	-26	---	BACK	VERT	TOTAL	---
AQ	17-2-12	-26	-26	---	BACK	VERT	TOTAL	---
AR	19-2-12	-26	-26	---	BACK	VERT	TOTAL	---
AS	23-2-12	-26	-26	---	BACK	VERT	TOTAL	---
AT	25-2-12	-26	-26	---	BACK	VERT	TOTAL	---
AU	27-2-12	-26	-26	---	BACK	VERT	TOTAL	---
AV	29-2-12	-26	-26	---	BACK	VERT	TOTAL	---
AW	33-2-12	-26	-26	---	BACK	VERT	TOTAL	---

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007145

JOB NAME 408169	TRUSS NAME T20Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 5 Oct 29 2019 Mtek Industries, Inc. Sat Apr 25 12:49:25 2020 Page 1
 ID:K7TPdHgJnpl1q1YdbWOFzIdaG-AKHFWntP09K_cKTP8gXCi67DKWF2Jk9bCKQw7zN8De
 1.38 0.0 4.0-11 4.0-11 5.5-11 9.0-6 5.4-7 14.10-13 28.4 17.7.0 20.3-4 5.4-7 25.7-11 27.6-12 29.0-12 31.18-31.6-12 35.2.0 36.5-8
 Scale = 1:57.3

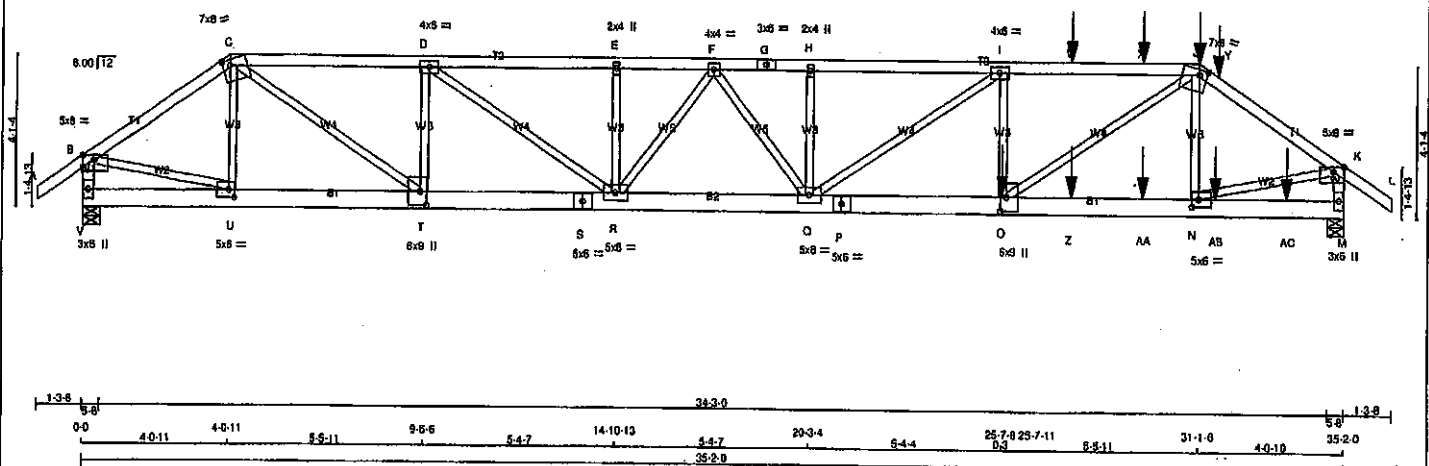

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - G	2x4	DRY No.2	SPF
G - J	2x4	DRY No.2	SPF
J - L	2x4	DRY No.2	SPF
V - B	2x4	DRY No.2	SPF
M - K	2x4	DRY No.2	SPF
V - S	2x6	DRY No.2	SPF
S - P	2x6	DRY No.2	SPF
P - M	2x6	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS	# ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS			
A - C	1	12	TOP
C - G	1	12	TOP
G - J	1	12	SIDE(61.0)
J - L	1	12	SIDE(61.0)
V - B	1	12	TOP
M - K	1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS			
V - S	2	12	TOP
S - P	2	12	TOP
P - M	2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS			
2x3	1	8	SIDE(557.9)
I - O	1	3	
D - T	1	3	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILO HANGERS ARE FASTENED WITH MIN. 3.0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT 2938	0	0	5-8
V	HORZ 4796	0	0	5-8
M	DOWN 4796	0	0	5-8

UNFACTORED REACTIONS

	1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
V	2073	1388 / 0 0 / 0 0 / 0 0 / 0 684 / 0 0 / 0
M	3381	2278 / 0 0 / 0 0 / 0 0 / 0 1103 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.57 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			WEBS		
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO	
A-B	0 / 35	-81.8 -91.8 0.07 (1)	10.00	U-C	-564 / 0 0.07 (1)
B-C	-3442 / 0	-81.8 -91.8 0.20 (1)	4.88	C-T	0 / 3700 0.46 (1)
C-D	-5905 / 0	-81.8 -91.8 0.43 (1)	3.70	T-D	-1983 / 0 0.25 (1)
D-E	-7947 / 0	-81.8 -91.8 0.58 (1)	3.11	D-R	0 / 2485 0.31 (1)
E-F	-7947 / 0	-81.8 -91.8 0.31 (1)	3.30	R-E	-368 / 0 0.05 (1)
F-G	-9222 / 0	-81.8 -91.8 0.38 (1)	3.01	Q-H	-348 / 0 0.04 (1)
G-H	-9222 / 0	-81.8 -91.8 0.38 (1)	3.01	O-I	-503 / 0 0.19 (1)
H-I	-9222 / 0	-81.8 -91.8 0.77 (1)	2.73	O-I	-397 / 0 0.05 (1)
I-W	-9635 / 0	-81.8 -91.8 0.88 (1)	2.57	O-J	0 / 5776 0.71 (1)
W-X	-9635 / 0	-81.8 -91.8 0.88 (1)	2.57	N-J	-915 / 0 0.12 (1)
X-J	-9635 / 0	-81.8 -91.8 0.88 (1)	2.57	B-U	0 / 2940 0.36 (1)
J-Y	-5847 / 0	-81.8 -91.8 0.33 (1)	3.78	N-K	0 / 5020 0.82 (1)
Y-K	-5847 / 0	-81.8 -91.8 0.33 (1)	3.78	R-F	-1209 / 0 0.21 (1)
K-L	0 / 35	-81.8 -91.8 0.07 (1)	10.00	F-Q	0 / 974 0.12 (1)
V-B	-2914 / 0	0.0 0.0 0.18 (1)	6.74		
M-K	-4771 / 0	0.0 0.0 0.27 (1)	5.48		
V-U	0 / 0	-18.5 -18.5 0.03 (4)	10.00		
U-T	0 / 2843	-18.5 -18.5 0.21 (1)	10.00		
T-S	0 / 5908	-18.5 -18.5 0.44 (1)	10.00		
S-R	0 / 5908	-18.5 -18.5 0.44 (1)	10.00		
R-Q	0 / 8853	-18.5 -18.5 0.82 (1)	10.00		
Q-P	0 / 9633	-18.5 -18.5 0.72 (1)	10.00		
P-O	0 / 9633	-18.5 -18.5 0.72 (1)	10.00		
O-Z	0 / 4855	-18.5 -18.5 0.41 (1)	10.00		
Z-AA	0 / 4855	-18.5 -18.5 0.41 (1)	10.00		
AA-N	0 / 4855	-18.5 -18.5 0.41 (1)	10.00		
N-AB	0 / 0	-18.5 -18.5 0.06 (4)	10.00		
AB-AC	0 / 0	-18.5 -18.5 0.08 (4)	10.00		
AC-M	0 / 0	-18.5 -18.5 0.06 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	GONN.
J	31-1-6	-49	-55	FRONT	VERT	DEAD	---	C1
J	31-1-6	-254	-254	FRONT	VERT	SNOW	---	C1
O	25-7-8	-2840	-2840	FRONT	VERT	TOTAL	---	C1
W	27-8-12	-110	-110	FRONT	VERT	TOTAL	---	C1
X	29-8-12	-110	-110	FRONT	VERT	TOTAL	---	C1
Y	31-6-12	-136	-136	FRONT	VERT	TOTAL	---	C1
Z	27-8-12	-26	-26	FRONT	VERT	TOTAL	---	C1
AA	29-8-12	-26	-26	FRONT	VERT	TOTAL	---	C1
AB	31-6-12	-26	-26	FRONT	VERT	TOTAL	---	C1
AC	33-8-12	-26	-26	FRONT	VERT	TOTAL	---	C1

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***

GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.

LOADS WERE DERIVED FROM USER INPUT

NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:			
TOP CH.	LL	=	25.8 PSF
	DL	=	6.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.4 PSF
TOTAL LOAD		=	39.0 PSF

SPACING = 24.0 IN. G.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***

ADDTL. USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.17")

CALCULATED VERT. DEFL.(LL) = $L/989$ (0.28")

ALLOWABLE DEFL.(TL) = $L/360$ (1.17")

CALCULATED VERT. DEFL.(TL) = $L/832$ (0.51")

CSI: TC=0.89/1.00 (I-J:1), BC=0.72/1.00 (O-Q:1), WB=0.71/1.00 (J-O:1), SS=0.18/1.00 (I-J:1)

DOLLUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	818 354 1667 788 1987 1666	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (CI) (INPUT = 0.89)

JSI METAL = 0.87 (SI) (INPUT = 1.00)

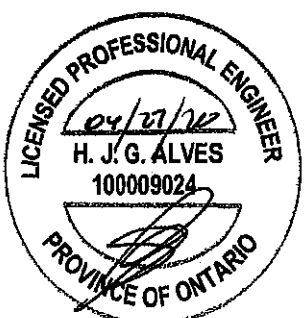

Structural component only
 DWG# T-2007146 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T20Z	1	2	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 28 2019 Mitek Industries, Inc. Sat Apr 25 12:49:25 2020 Page 2
ID:K7TPdngQnpltdYdbWIOFzIdeG-AKHFWtPgK ckTp9qXCi67DKWF2Lk9bCKqW7znNBDe

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMWW-p	MT20	5.0	8.0	1.50 3.50
C	TTWW-m	MT20	7.0	8.0	1.75 2.50
D	TMWW-t	MT20	4.0	6.0	
E	TMWW-w	MT20	2.0	4.0	
F	TMWW-t	MT20	4.0	4.0	
G	TS-t	MT20	3.0	6.0	
H	TMWW-w	MT20	2.0	4.0	
I	TMWW-t	MT20	4.0	8.0	
J	TTWW-m	MT20	7.0	8.0	1.75 2.50
K	TMWW-p	MT20	5.0	8.0	1.50 3.50
M	BMV1-p	MT20	3.0	6.0	
N	BMWW-t	MT20	5.0	8.0	2.50 2.00
O	BMWW-t	MT20	6.0	9.0	4.50 2.00
P	BS-t	MT20	5.0	6.0	
Q	BMWW-t	MT20	5.0	8.0	
R	BMWW-t	MT20	5.0	8.0	
S	BS-t	MT20	5.0	6.0	
T	BMWW-t	MT20	6.0	9.0	4.50 2.00
U	BMWW-t	MT20	5.0	8.0	2.50 2.00
V	BMV1-p	MT20	3.0	6.0	


CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007146 42

JOB NAME 408169	TRUSS NAME T21	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:26 2020 Page 1 ID:K7TPdngl0npl1qYdbWOFzIdaG-eWrd5G2ZTSrDU10Q2RPJgONWdaSrJps4OSZzNBDD	

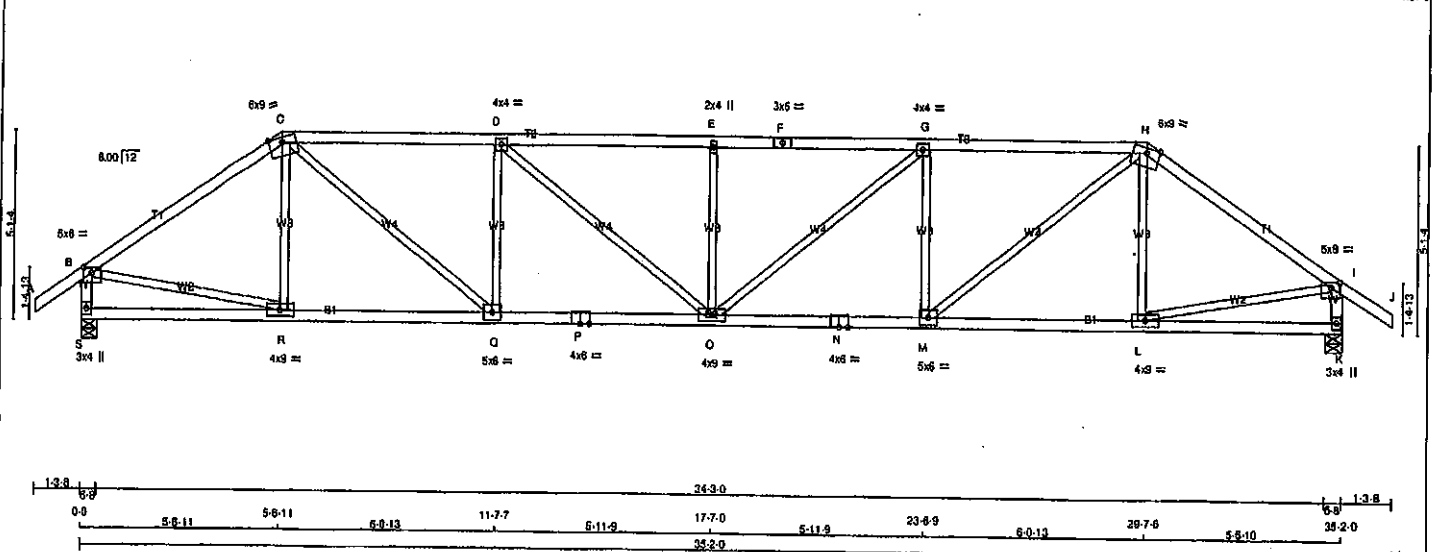

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
J - L	2x4	DRY	No.2
L - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.75 2.75
C	TTWW-m	MT20	6.0	9.0	Edge
D	TMVW-l	MT20	4.0	4.0	
E	TMVW-w	MT20	2.0	4.0	
F	TS-l	MT20	3.0	6.0	
G	TMVW-l	MT20	4.0	4.0	
H	TTWW-m	MT20	6.0	9.0	Edge
I	TMVW-p	MT20	5.0	8.0	1.75 2.75
K	BMV1-p	MT20	3.0	4.0	
L	BMVW-l	MT20	4.0	9.0	
M	BMVW-l	MT20	5.0	6.0	
N	BS-l	MT20	4.0	6.0	
O	BMVW-l	MT20	4.0	9.0	
P	BS-l	MT20	4.0	6.0	
Q	BMVW-l	MT20	5.0	6.0	
R	BMVW-l	MT20	4.0	9.0	
S	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	BRG	UPLIFT	BRG	IN-SX
S	2065	0	0	2065	0	0	5-8	5-8	
K	2065	0	0	2065	0	0	5-8	5-8	

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1458	970/0	0/0	0/0	0/0	488/0	0/0
K	1458	970/0	0/0	0/0	0/0	488/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 2.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 (PL)	MEMB.	FORCE (LBS)	VERT. LOAD	LC1 (PL)
FR-TO				FR-TO			
A-B	0/35	-91.8	-91.8 0.12 (1)	H-C	-243/10	0.09 (1)	
B-C	-2297/0	-91.8	-91.8 0.70 (1)	C-Q	0/1989	0.38 (1)	
C-D	-3213/0	-91.8	-91.8 0.89 (1)	D-O	-929/0	0.38 (1)	
D-E	-3594/0	-91.8	-91.8 0.88 (1)	O-E	0/499	0.11 (1)	
E-F	-3594/0	-91.8	-91.8 0.88 (1)	E-G	-505/0	0.19 (1)	
F-G	-3594/0	-91.8	-91.8 0.88 (1)	G-H	0/490	0.11 (1)	
G-H	-3213/0	-91.8	-91.8 0.90 (1)	H-I	-929/0	0.38 (1)	
H-I	-2296/0	-91.8	-91.8 0.70 (1)	I-J	0/1870	0.38 (1)	
I-J	0/35	-91.8	-91.8 0.12 (1)	J-K	-243/10	0.09 (1)	
S-B	-2023/0	0.0	0.0 0.21 (1)	K-L	0/1943	0.44 (1)	
K-I	-2023/0	0.0	0.0 0.21 (1)	L-I	0/1943	0.44 (1)	
S-R	0/0	-18.5	-18.5 0.15 (4)				
R-Q	0/1904	-18.5	-18.5 0.39 (1)				
Q-P	0/3213	-18.5	-18.5 0.58 (1)				
P-O	0/3213	-18.5	-18.5 0.58 (1)				
O-N	0/3213	-18.5	-18.5 0.58 (1)				
N-M	0/3213	-18.5	-18.5 0.58 (1)				
M-L	0/1903	-18.5	-18.5 0.39 (1)				
L-K	0/0	-18.5	-18.5 0.15 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = 1/999 (0.21")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = 1/999 (0.38")

CSI: TC=0.88/1.00 (E-G:1), BC=0.58/1.00 (O-Q:1), WB=0.44/1.00 (B-R:1), SS=0.28/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1686

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.87 (B) (INPUT = 0.80)
JSI METAL = 0.74 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007147

JOB NAME 408169	TRUSS NAME T23	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Metek Industries, Inc. Sat Apr 25 12:49:28 2020 Page 1
ID:K7TPdng0npt1q1YdbWfOfZdeG-byvNWxv54IZToBQqp4vKknEJLmwVbHAZVXRzNBOb

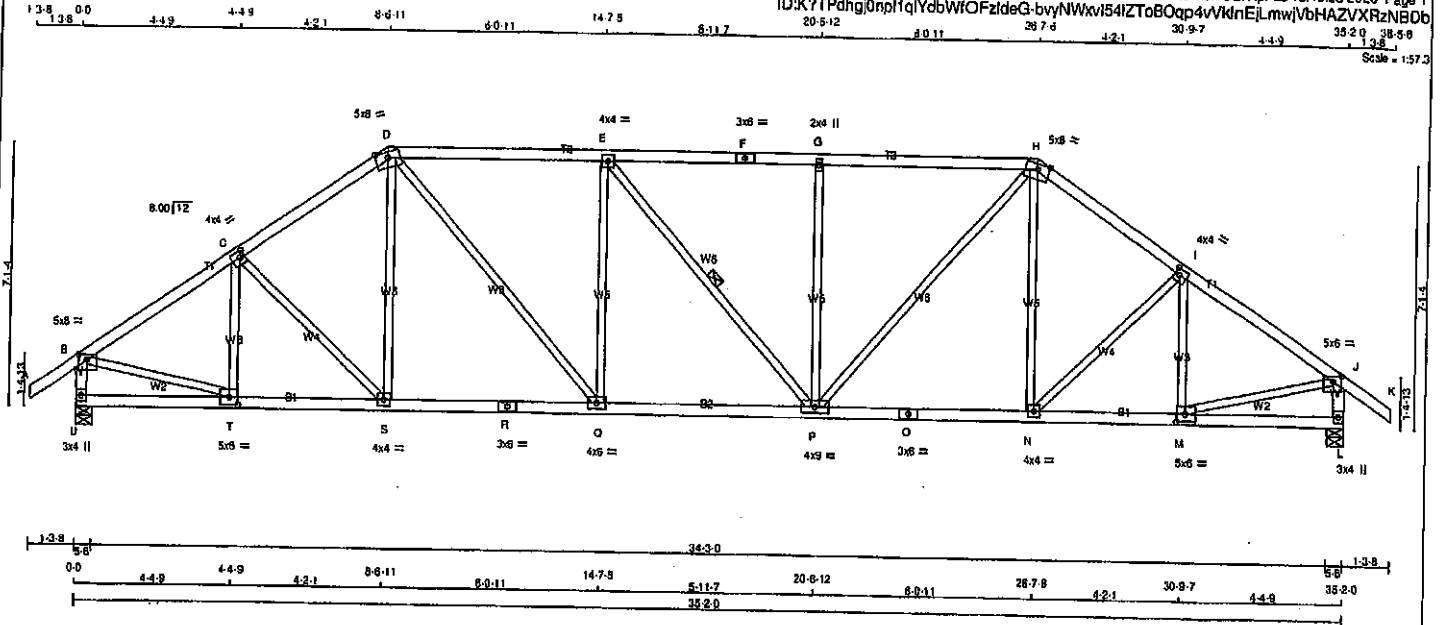

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMVW-p	MT20	5.0	6.0	1.75 2.75
C TMVW-w	MT20	4.0	4.0	2.00 1.50
D TTWW-m	MT20	5.0	8.0	Edge
E TMVW-l	MT20	4.0	4.0	
F TS-l	MT20	3.0	8.0	
G TMVW-w	MT20	2.0	4.0	
H TTWW-m	MT20	5.0	8.0	Edge
I TMVW-l	MT20	4.0	4.0	2.00 1.50
J TMVW-p	MT20	5.0	6.0	1.75 2.75
L BMV-l+p	MT20	3.0	4.0	
M BMVW-l	MT20	5.0	6.0	2.50 2.75
N BMVW-l	MT20	4.0	4.0	
O BS-l	MT20	3.0	8.0	
P BMVW-w	MT20	4.0	8.0	
Q BMVW-l	MT20	4.0	8.0	
R BS-l	MT20	3.0	8.0	
S BMVW-l	MT20	5.0	6.0	2.50 2.75
T BMVW-l	MT20	5.0	6.0	
U BMV-l+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
U	2065	0	2065	0	5-8
L	2065	0	2065	0	5-8

UNFACTORED REACTIONS

1ST CASE		MAX/MIN COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
U	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0
L	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		FR-TO	
A-B	0 / 35	-91.8 -91.8 0.12 (1)	10.00	T-C	-398 / 0
B-C	-2270 / 0	-91.8 -91.8 0.37 (1)	4.19	C-S	-79 / 0
C-D	-2254 / 0	-91.8 -91.8 0.38 (1)	4.21	S-D	0 / 156
D-E	-2485 / 0	-91.8 -91.8 0.64 (1)	3.72	D-Q	0 / 949
E-F	-2483 / 0	-91.8 -91.8 0.64 (1)	3.72	Q-E	-597 / 0
F-G	-2483 / 0	-91.8 -91.8 0.64 (1)	3.72	E-P	-2 / 0
G-H	-2483 / 0	-91.8 -91.8 0.63 (1)	3.74	P-G	-596 / 0
H-I	-2254 / 0	-91.8 -91.8 0.38 (1)	4.21	P-H	0 / 947
I-J	-2289 / 0	-91.8 -91.8 0.37 (1)	4.19	N-H	0 / 157
J-K	0 / 35	-91.8 -91.8 0.12 (1)	10.00	N-I	-78 / 0
K-B	-2027 / 0	0.0 0.0 0.21 (1)	5.94	M-I	-397 / 0
L-J	-2026 / 0	0.0 0.0 0.21 (1)	5.94	B-T	0 / 1966
U-T	0 / 0	-18.5 -18.5 0.08 (4)	10.00	M-J	0 / 1965
T-S	0 / 1909	-18.5 -18.5 0.37 (1)	10.00		
S-R	0 / 1854	-18.5 -18.5 0.36 (1)	10.00		
R-O	0 / 1854	-18.5 -18.5 0.38 (1)	10.00		
O-P	0 / 2485	-18.5 -18.5 0.64 (1)	10.00		
P-O	0 / 1854	-18.5 -18.5 0.47 (1)	10.00		
O-N	0 / 1854	-18.5 -18.5 0.38 (1)	10.00		
N-M	0 / 1908	-18.5 -18.5 0.37 (1)	10.00		
M-L	0 / 0	-18.5 -18.5 0.08 (4)	10.00		

TOTAL WEIGHT = 2 X 155 = 309 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/899 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/989 (0.24")

CSI: TC=0.64/1.00 (D-E:1), BC=0.47/1.00 (P-Q:1),
WB=0.52/1.00 (E-Q:1), SSI=0.26/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 018 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.90 (D) (INPUT = 0.90)
JSI METAL= 0.62 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007149

Structural component only
DWG# T-2007150

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T25	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:30 2020 Page 1					
ID:K?TPdhgJ0npl1qIYdbWfOfZdeG-XI48xdvYdiYHfLnyE7Na9q9dX2T0e3ukU2bbK2NBDZ					
Scale = 1:57.3					

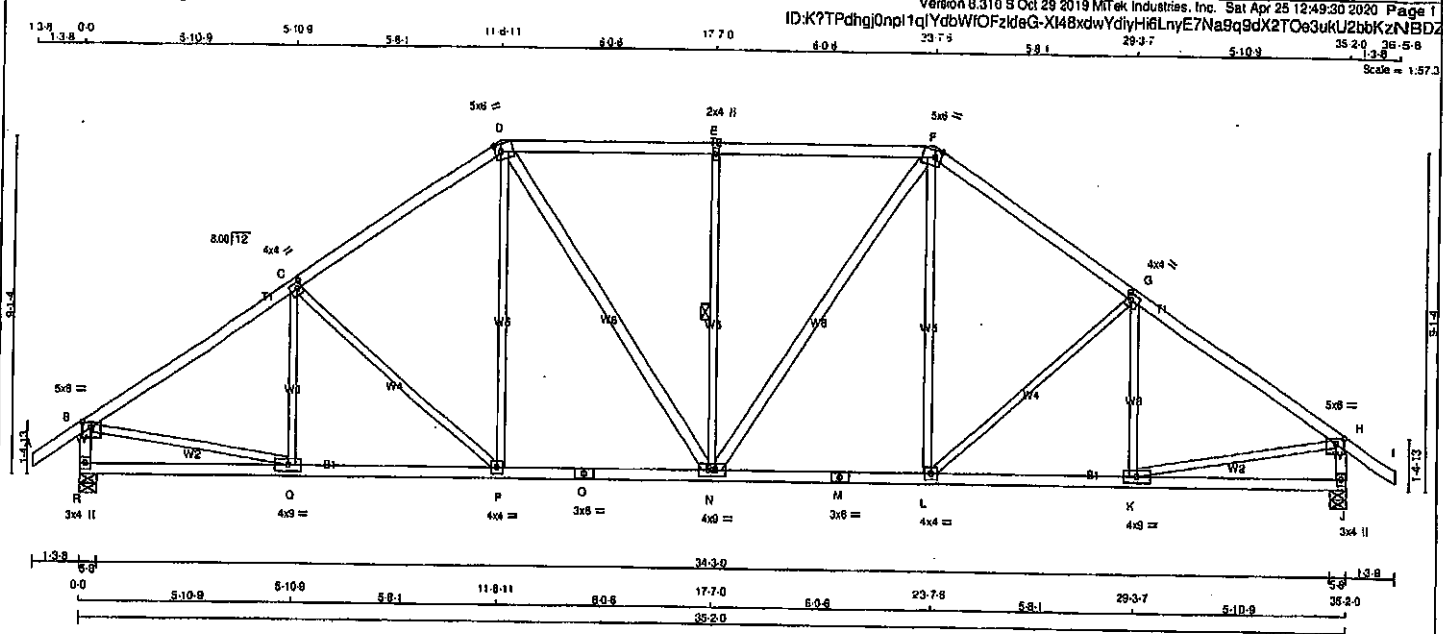

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - F	2x4	DRY	No.2	SPF		
F - I	2x4	DRY	No.2	SPF		
R - B	2x4	DRY	No.2	SPF		
J - H	2x4	DRY	No.2	SPF		
R - O	2x4	DRY	No.2	SPF		
O - M	2x4	DRY	No.2	SPF		
M - J	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						
D - N	2x4	DRY	No.2	SPF		
N - F	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.75	2.75
C	TMVW-1	MT20	4.0	4.0	2.00	1.50
D	TTWW-m	MT20	5.0	6.0	2.25	2.00
E	TMVW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.25	2.00
G	TMVW-1	MT20	4.0	4.0	2.00	1.50
H	TMVW-p	MT20	5.0	8.0	1.75	2.75
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-1	MT20	4.0	9.0		
L	BMVW-1	MT20	4.0	4.0		
N	BS-1	MT20	3.0	6.0		
O	BS-1	MT20	4.0	9.0		
P	BS-1	MT20	3.0	6.0		
Q	BMVW-1	MT20	4.0	4.0		
R	BMV1-p	MT20	4.0	9.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQHD
GROSS REACTION	GROSS REACTION	DOWN	HORIZ	UPLIFT
JT	VERT	2065	0	0
R	VERT	2065	0	0
J	VERT	2065	0	0

UNFACTORED REACTIONS							
	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
R	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED
MEMB.	FORCE	(PLF)	(PLF)	CS1 (LC)	UNBRAC	CS1 (LC)	MEMB.	FORCE
FR-TO							FR-TO	
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	0.11 (1)	Q-C	-248 / 11
B-C	-2347 / 0	-91.8	-91.8	0.52 (1)	3.99	0.42 (1)	C-P	-356 / 0
C-D	-2096 / 0	-91.8	-91.8	0.48 (1)	4.22	0.08 (1)	P-D	0 / 342
D-E	-1985 / 0	-91.8	-91.8	0.49 (1)	4.26	0.08 (1)	D-N	0 / 477
E-F	-1885 / 0	-91.8	-91.8	0.49 (1)	4.26	0.37 (1)	N-E	-877 / 0
F-G	-2095 / 0	-91.8	-91.8	0.48 (1)	4.22	0.08 (1)	N-F	0 / 477
G-H	-2346 / 0	-91.8	-91.8	0.52 (1)	3.99	0.08 (1)	L-F	0 / 341
H-I	0 / 35	-91.8	-91.8	0.12 (1)	10.00	0.42 (1)	L-G	-356 / 0
I-J	-2018 / 0	0.0	0.0	0.21 (1)	5.94	0.11 (1)	K-G	-249 / 11
J-H	-2018 / 0	0.0	0.0	0.21 (1)	5.94	0.45 (1)	B-Q	0 / 2014
R-Q	0 / 0	-18.5	-18.5	0.14 (4)	10.00	0.45 (1)	K-H	0 / 2014
Q-P	0 / 1981	-18.5	-18.5	0.39 (1)	10.00			
P-O	0 / 1716	-18.5	-18.5	0.34 (1)	10.00			
O-N	0 / 1716	-18.5	-18.5	0.34 (1)	10.00			
N-M	0 / 1716	-18.5	-18.5	0.34 (1)	10.00			
M-L	0 / 1716	-18.5	-18.5	0.34 (1)	10.00			
L-K	0 / 1980	-18.5	-18.5	0.39 (1)	10.00			
K-J	0 / 0	-18.5	-18.5	0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, CBC 2012, ABC 2010
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CS1: TC=0.52/1.00 (B-C:1), BC=0.39/1.00 (P-Q:1), WB=0.45/1.00 (B-Q:1), SS1=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (B) (INPUT = 0.80)
JSI METAL= 0.56 (M) (INPUT = 1.00)




Structural component only
DWG# T-2007151

JOB NAME 408169	TRUSS NAME T26	QUANTITY 5	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtlak Industries, Inc. Sat Apr 25 12:49:32 2020 Page 1
ID:K7TPdhgJ0np1qYdbWfOZkdeG-TgCuMjy09JC7yPVA3e9fawTUKjTsYXBCoXlgDzNBDX

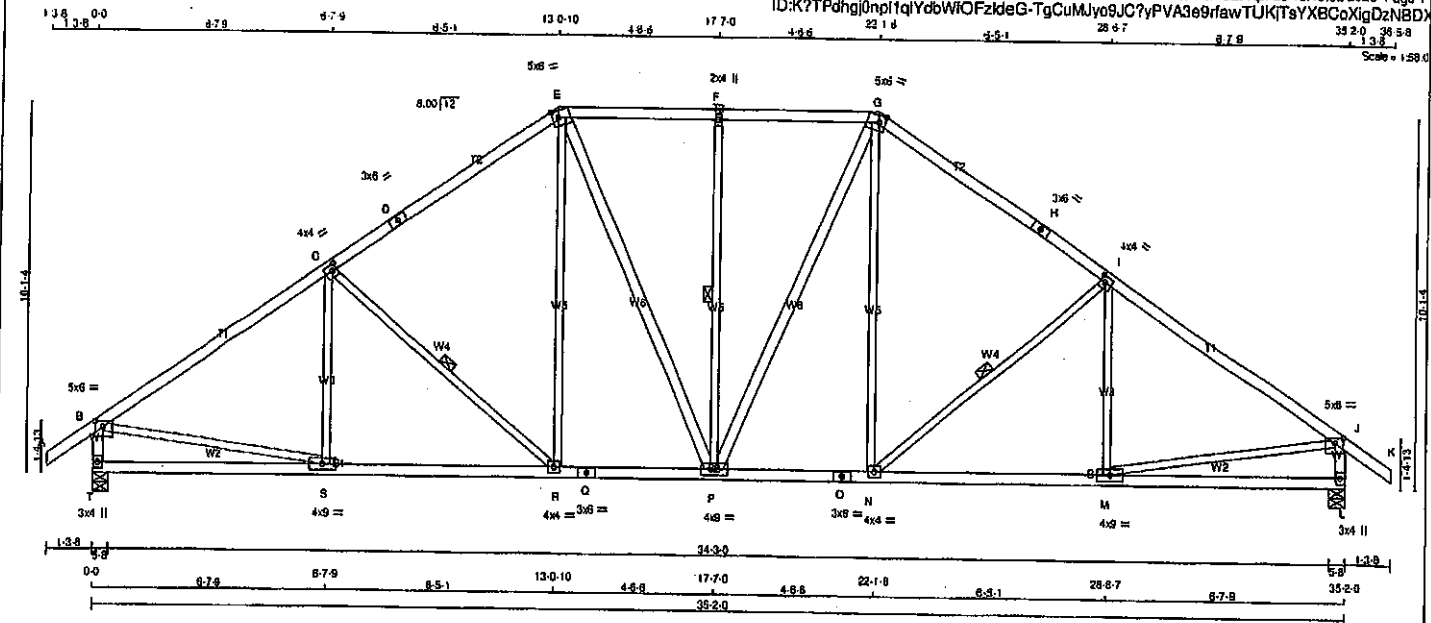

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
T - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
T - Q	2x4	DRY	No.2
Q - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
E - P	2x4	DRY	No.2
P - G	2x4	DRY	No.2

DRY, SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.75 2.75
C	TMVW-t	MT20	4.0	4.0	2.00 1.50
D	TS-1	MT20	3.0	8.0	
E	TTWW-m	MT20	5.0	8.0	2.25 2.00
F	TMVW-m	MT20	2.0	4.0	
G	TTWW-m	MT20	5.0	8.0	2.25 2.00
H	TS-1	MT20	3.0	8.0	
I	TMVW-t	MT20	4.0	4.0	2.00 1.50
J	TMVW-p	MT20	5.0	8.0	1.75 2.75
L	BMVW-p	MT20	3.0	4.0	
M	BMVW-t	MT20	4.0	9.0	
N	BMVW-t	MT20	4.0	4.0	
O	BS-1	MT20	3.0	8.0	
P	BS-1	MT20	4.0	9.0	
Q	BS-1	MT20	3.0	8.0	
R	BS-1	MT20	4.0	4.0	
S	BS-1	MT20	4.0	9.0	
T	BS-1	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
	FACTORED	MAXIMUM FACTORED	INPUT
	GROSS REACTION	GROSS REACTION	BRG
JT	VERT	DOWN	BRG
T	2065	0	5-8
L	2065	0	5-8

UNFACTORED REACTIONS			
1ST CASE	MAX/MIN	COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE
T	1458	970 / 0	0 / 0
L	1458	970 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-R, F-P, I-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CS1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	S-G	-189 / 46	0.10 (1)
B-C	-2359 / 0	-91.8	-91.8 0.09 (1)	10.00	C-R	-485 / 0	0.24 (1)
C-D	-1996 / 0	-91.8	-91.8 0.02 (1)	10.00	H-E	0 / 416	0.09 (1)
D-E	-1996 / 0	-91.8	-91.8 0.02 (1)	10.00	E-P	0 / 315	0.05 (1)
E-F	-1761 / 0	-91.8	-91.8 0.27 (1)	10.00	P-F	-502 / 0	0.35 (1)
F-G	-1761 / 0	-91.8	-91.8 0.27 (1)	10.00	P-G	0 / 315	0.05 (1)
G-H	-1996 / 0	-91.8	-91.8 0.02 (1)	10.00	N-G	0 / 415	0.09 (1)
H-I	-1996 / 0	-91.8	-91.8 0.02 (1)	10.00	N-I	-484 / 0	0.24 (1)
I-J	-2358 / 0	-91.8	-91.8 0.09 (1)	10.00	M-I	-189 / 46	0.10 (1)
J-K	0 / 35	-91.8	-91.8 0.12 (1)	10.00	B-S	0 / 2022	0.45 (1)
T-B	-2014 / 0	0.0	0.0 0.21 (1)	5.95	M-J	0 / 2021	0.45 (1)
L-J	-2014 / 0	0.0	0.0 0.21 (1)	5.95			
T-S	0 / 0	-18.5	-18.5 0.19 (4)	10.00			
S-R	0 / 1996	-18.5	-18.5 0.42 (1)	10.00			
R-Q	0 / 1629	-18.5	-18.5 0.32 (1)	10.00			
Q-P	0 / 1629	-18.5	-18.5 0.32 (1)	10.00			
P-O	0 / 1629	-18.5	-18.5 0.32 (1)	10.00			
O-N	0 / 1620	-18.5	-18.5 0.32 (1)	10.00			
N-M	0 / 1995	-18.5	-18.5 0.42 (1)	10.00			
M-L	0 / 0	-18.5	-18.5 0.19 (4)	10.00			

TOTAL WEIGHT = 5 X 172 = 858 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (1.17")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.09")
ALLOWABLE DEFL. (TL) = $L/360$ (1.17")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.18")

CS: TC=0.89/1.00 (B-C:1), BC=0.42/1.00 (R-S:1), WB=0.45/1.00 (B-S:1), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES


PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788
	1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (B) (INPUT = 0.80)

JSI METAL= 0.50 (O) (INPUT = 1.00)

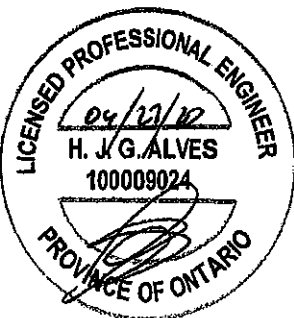


Structural component only
DWG# T-2007152

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T27	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Tamarack Roof Truss, Burlington

Version 8.310 S.Oct 28 2019 Mitek Industries, Inc. Sat Apr 25 12:49:33 2020 Page 1
ID:K7TPdhgJ0npl1qIYdbWfOFzKdeG-xlmGZfzRwdKzZ4MdMq4CoSb3k2Cb?nKQSHGCIzNBDW

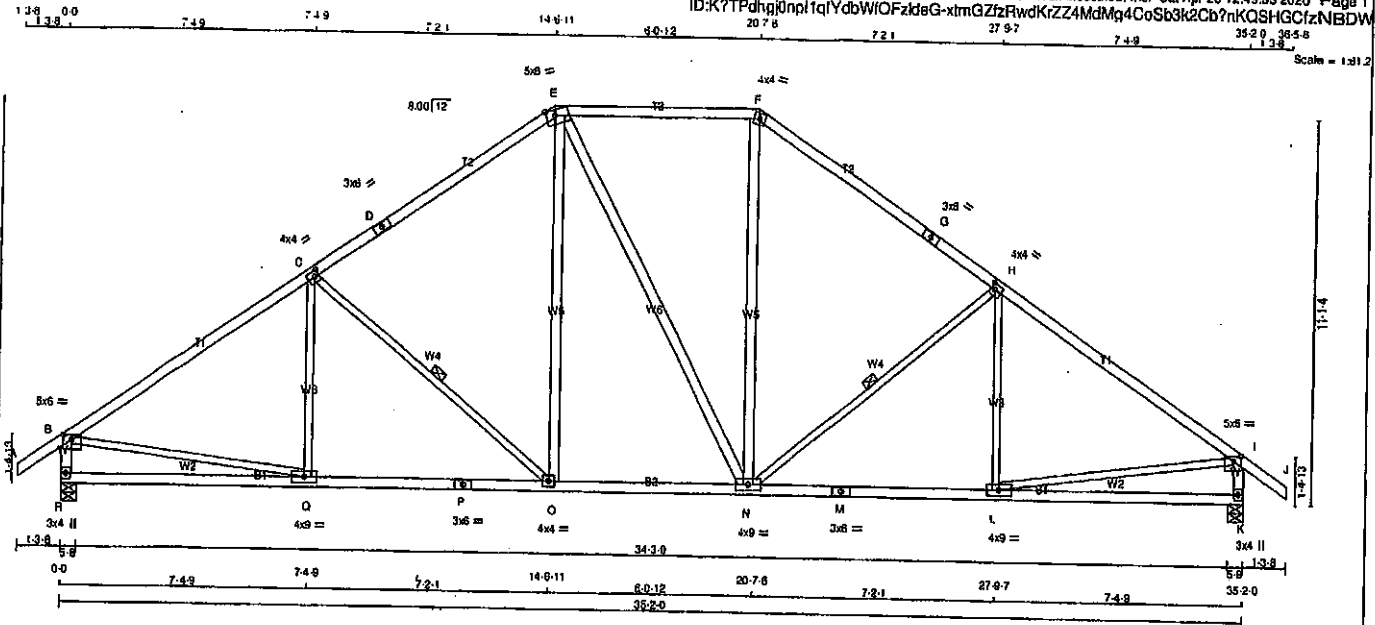

N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
F - G	2x4	DRY	No.2	SPF	
G - J	2x4	DRY	No.2	SPF	
R - B	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
P - P	2x4	DRY	No.2	SPF	
R - M	2x4	DRY	No.2	SPF	
M - K	2x4	DRY	No.2	SPF	

ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	
O - E	2x4	DRY	No.2	SPF	
E - N	2x4	DRY	No.2	SPF	
N - F	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMW-p	MT20	5.0	6.0	1.75	2.75
C TMW-W	MT20	4.0	4.0	2.00	1.50
D TS-1	MT20	3.0	8.0		
E TTW-m	MT20	5.0	8.0	2.00	3.00
F TTW-m	MT20	4.0	4.0		
G TS-1	MT20	3.0	8.0		
H TMW-W	MT20	4.0	4.0	2.00	1.50
I TMW-p	MT20	5.0	8.0	1.75	2.75
K BMW-1-p	MT20	3.0	4.0		
L BMW-W	MT20	4.0	9.0		
M BS-1	MT20	3.0	6.0		
N BMW-W-1	MT20	4.0	9.0		
O BMW-W-1	MT20	4.0	4.0		
P BS-1	MT20	3.0	6.0		
Q BMW-W-1	MT20	4.0	9.0		
R BMW-1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
VERT	VERT	DOWN	UP	IN-SX
R	2085	0	2085	0
K	2085	0	2085	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
COMBINED								
R	1458	970	0	0	0	0	488	0
K	1458	970	0	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.45 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-Q, H-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO					FR-TO			
A-B	0/35	-91.8	-91.8	0.12 (1)	10.00	Q-C	-139/76	0.09 (1)
B-C	-2358/0	-91.8	-91.8	0.89 (1)	3.45	C-D	-605/0	0.38 (1)
C-D	-1888/0	-91.8	-91.8	0.78 (1)	3.91	D-E	0/498	0.08 (1)
D-E	-1539/0	-91.8	-91.8	0.78 (1)	3.91	E-F	0/0	0.00 (1)
E-F	-1888/0	-91.8	-91.8	0.47 (1)	4.74	F-G	0/500	0.08 (1)
F-G	-1888/0	-91.8	-91.8	0.78 (1)	3.91	G-H	-604/0	0.38 (1)
G-H	-1888/0	-91.8	-91.8	0.78 (1)	3.91	H-I	-140/75	0.09 (1)
H-I	-2357/0	-91.8	-91.8	0.89 (1)	3.45	I-J	0/2020	0.45 (1)
I-J	0/35	-91.8	-91.8	0.12 (1)	10.00	J-K	0/2019	0.45 (1)
J-K	-2009/0	0.0	0.0	0.21 (1)	5.95			
K-L	-2009/0	0.0	0.0	0.21 (1)	5.95			
R-Q	0/0	-18.5	-18.5	0.25 (4)	10.00			
Q-P	0/1989	-18.5	-18.5	0.45 (1)	10.00			
P-O	0/1989	-18.5	-18.5	0.45 (1)	10.00			
O-N	0/1538	-18.5	-18.5	0.33 (1)	10.00			
N-M	0/1988	-18.5	-18.5	0.45 (1)	10.00			
M-L	0/1988	-18.5	-18.5	0.45 (1)	10.00			
L-K	0/0	-18.5	-18.5	0.24 (4)	10.00			

TOTAL WEIGHT = 2 X 168 = 336 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.8 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIG 2011, TPIG 2014

(85% OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.17)
CALCULATED VERT. DEFL.(LL) = $L/899$ (0.09)
ALLOWABLE DEFL.(TL) = $L/360$ (1.17)
CALCULATED VERT. DEFL.(TL) = $L/899$ (0.20)

CSK TC=0.89/1.00 (B-C:1), SC=0.45/1.00 (O-Q:1),
WB=0.45/1.00 (B-Q:1), SS=0.27/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1867 788 1987 1856	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (F) (INPUT = 0.90)
JSI METAL= 0.88 (P) (INPUT = 1.00)




Structural component only
DWG# T-2007153

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T28	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 28 2019 MITek Industries, Inc. Sat Apr 25 12:49:34 2020 Page 1
ID:K7TPdghj0npl1qYdbWIOFzIdeG-P3JIn7_3gwSIBjYB3Bjk77uz8RBKVIL60p15zNBDV

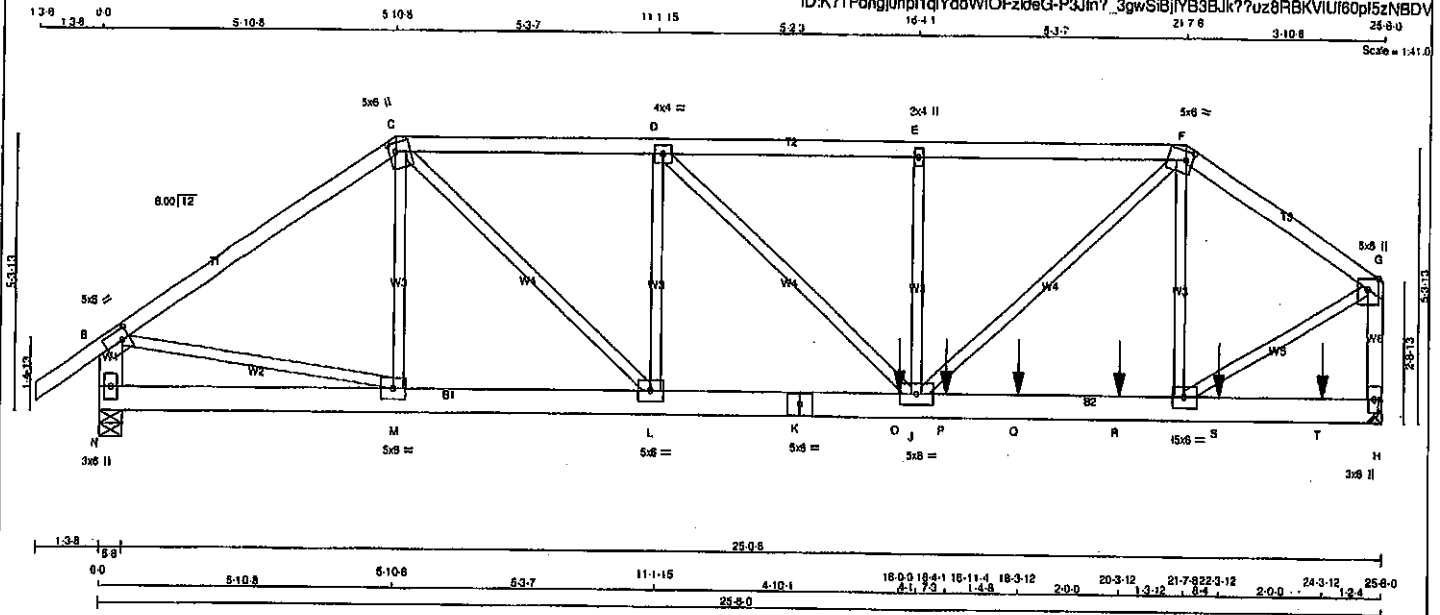

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR
A - C	2x4	DRY	No.2		SPF
C - F	2x4	DRY	No.2		SPF
F - G	2x4	DRY	No.2		SPF
N - B	2x6	DRY	No.2		SPF
H - G	2x4	DRY	No.2		SPF
N - K	2x6	DRY	No.2		SPF
K - H	2x6	DRY	No.2		SPF
ALL WEBS	2x3	DRY	No.2		SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
C - F	12	TOP
F - G	12	TOP
H - G	12	TOP
N - B	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
N - K	12	TOP
K - H	12	SIDE (183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
E - J	6	SIDE (77.0)
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ.	DOWN	HORZ		
N	2088	0	2088	0	5-8	5-8
H	2756	0	2756	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3'-8".

UNFACTORED REACTIONS

JT	1ST CASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
N	1470	994 / 0	0 / 0	0 / 0	0 / 0	478 / 0	0 / 0
H	1941	1320 / 0	0 / 0	0 / 0	0 / 0	620 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.78 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LOC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO			FR-TO			
A-B	0 / 35	-91.8	-91.8	0.07 (1)	10.00	M-C	-218 / 22	0.04 (1)
B-C	-2383 / 0	-91.8	-91.8	0.37 (1)	5.41	C-L	0 / 1550	0.19 (1)
C-D	-3093 / 0	-91.8	-91.8	0.24 (1)	5.03	L-D	-928 / 0	0.19 (1)
D-E	-3519 / 0	-91.8	-91.8	0.25 (1)	4.76	D-J	0 / 589	0.07 (1)
E-F	-3519 / 0	-91.8	-91.8	0.24 (1)	4.79	J-E	-508 / 0	0.10 (1)
F-G	-2352 / 0	-91.8	-91.8	0.16 (1)	5.69	J-F	0 / 2156	0.27 (1)
N-B	-2037 / 0	0.0	0.0	0.07 (1)	7.81	I-F	-548 / 0	0.11 (1)
H-G	-2632 / 0	0.0	0.0	0.19 (1)	7.01	B-M	0 / 1991	0.25 (1)
					I-G	0 / 2264	0.28 (1)	
N-M	0 / 0	-18.5	-18.5	0.04 (4)	10.00			
M-L	0 / 1859	-18.5	-18.5	0.14 (1)	10.00			
L-K	0 / 3093	-18.5	-18.5	0.27 (1)	10.00			
K-O	0 / 3093	-18.5	-18.5	0.27 (1)	10.00			
O-J	0 / 3093	-18.5	-18.5	0.27 (1)	10.00			
J-P	0 / 1942	-18.5	-18.5	0.23 (1)	10.00			
P-Q	0 / 1942	-18.5	-18.5	0.23 (1)	10.00			
Q-R	0 / 1942	-18.5	-18.5	0.23 (1)	10.00			
R-I	0 / 1942	-18.5	-18.5	0.23 (1)	10.00			
I-S	0 / 0	-18.5	-18.5	0.10 (1)	10.00			
S-T	0 / 0	-18.5	-18.5	0.10 (1)	10.00			
T-H	0 / 0	-18.5	-18.5	0.10 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LOC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
O	18-0-0	-997	-997	---	FRONT	VERT	TOTAL	---	C1
P	18-11-4	-187	-187	---	FRONT	VERT	TOTAL	---	C1
Q	18-3-12	-187	-187	---	FRONT	VERT	TOTAL	---	C1
R	20-3-12	-187	-187	---	FRONT	VERT	TOTAL	---	C1
S	22-3-12	-174	-174	---	FRONT	VERT	TOTAL	---	C1
T	24-3-12	-173	-173	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2010, NBCO 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBCO 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.85")
CALCULATED VERT. DEFL. (LL) = L/999 (0.08")
ALLOWABLE DEFL. (TL) = L/360 (0.85")
CALCULATED VERT. DEFL. (TL) = L/999 (0.11")

CSI: TC=0.37/1.00 (B-C:1), BC=0.27/1.00 (J-L:1), WB=0.28/1.00 (G-I:1), SS=0.34/1.00 (J-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1857 788 1987 1856

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.90 (F) (INPUT = 0.90)
JSI METAL= 0.45 (G) (INPUT = 1.00)




Structural component only
DWG# T-2007154 1/2

CONTINUED ON PAGE 2

JOB NAME 408169	TRUSS NAME T29	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MIT Industries, Inc. Sat Apr 25 12:49:35 2020 Page 1
ID:K7TPdhgi0nph1qYdbWIOFzIdeG-IF11_L_hREaZptDkinYHDY1dYm23pNduumtMHYzNBdu

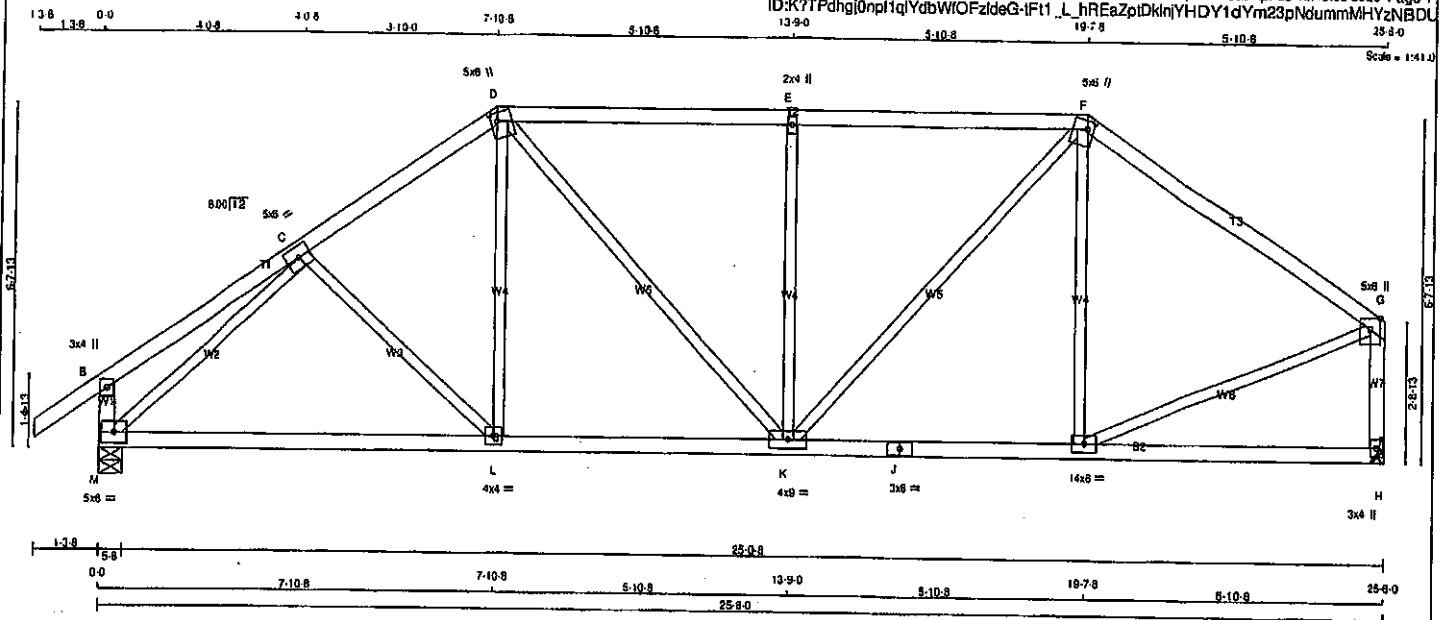

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
M - B	2x4	DRY	No.2
H - G	2x4	DRY	No.2
M - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	3.0	4.0		
O	TMVW-1	MT20	5.0	8.0		
D	TMVW+m	MT20	5.0	6.0	2.00	1.50
E	TMVW-w	MT20	2.0	4.0		
F	TMVW+m	MT20	5.0	6.0	2.00	1.50
G	TMVW-p	MT20	5.0	6.0	Edge	
H	BMV1-p	MT20	3.0	4.0		
I	BMVW-1	MT20	4.0	8.0		
J	BS-1	MT20	3.0	8.0		
K	BMVW-1	MT20	4.0	9.0		
L	BMVW-1	MT20	4.0	4.0		
M	BMVW-1	MT20	5.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	HORIZ	UPLIFT
M	1532	0	1532	0
H	1406	0	1406	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3'-6".

UNFACTORED REACTIONS

1ST CASE	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	1081	723 / 0	0 / 0	0 / 0	0 / 0	358 / 0	0 / 0
H	994	652 / 0	0 / 0	0 / 0	0 / 0	342 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.89 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 35	-91.8	-91.8 0.12 (1)	C-L	-80 / 27	0.04 (1)	0.04 (1)
B-C	0 / 22	-91.8	-91.8 0.22 (1)	D-K	0 / 209	0.05 (4)	0.05 (4)
C-D	-1491 / 0	-91.8	-91.8 0.19 (1)	E-K	0 / 354	0.08 (1)	0.08 (1)
D-E	-1464 / 0	-91.8	-91.8 0.44 (1)	F-K	-862 / 0	0.48 (1)	0.48 (1)
E-F	-1464 / 0	-91.8	-91.8 0.44 (1)	G-F	0 / 663	0.15 (1)	0.15 (1)
F-G	-1226 / 0	-91.8	-91.8 0.44 (1)	H-F	-282 / 0	0.21 (1)	0.21 (1)
M-B	-288 / 0	0.0	0.0 0.03 (1)	I-G	-1757 / 0	0.83 (1)	0.83 (1)
H-G	-1382 / 0	0.0	0.0 0.20 (1)	I-G	0 / 1098	0.25 (1)	0.25 (1)
M-L	0 / 1279	-18.5	-18.5 0.36 (4)				
L-K	0 / 1223	-18.5	-18.5 0.36 (4)				
K-J	0 / 1014	-18.5	-18.5 0.28 (1)				
J-I	0 / 1014	-18.5	-18.5 0.28 (1)				
I-H	0 / 0	-18.5	-18.5 0.17 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.65")
CALCULATED VERT. DEFL. (LL) = L/999 (0.05")
ALLOWABLE DEFL. (TL) = L/360 (0.65")
CALCULATED VERT. DEFL. (TL) = L/999 (0.15")

CSI: TC=0.44/1.00 (F-G:1), BC=0.38/1.00 (K-L:4), WB=0.83/1.00 (C-M:1), SSI=0.26/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.82 (D) (INPUT = 0.90)
JSI METAL=0.51 (G) (INPUT = 1.00)

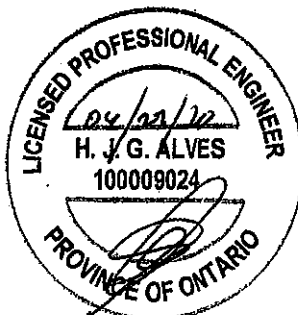


Structural component only
DWG# T-2007155

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408169	T30	2	1	TRUSS DESC.		

Tamareck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:38 2020 Page 1
ID:K?TPdhgJ0np1qYcbWIOFzIdG-MSRPCg?JCYIQQ10xIUEnpQ4FSy8zoKvN7QVwp_zNBDT

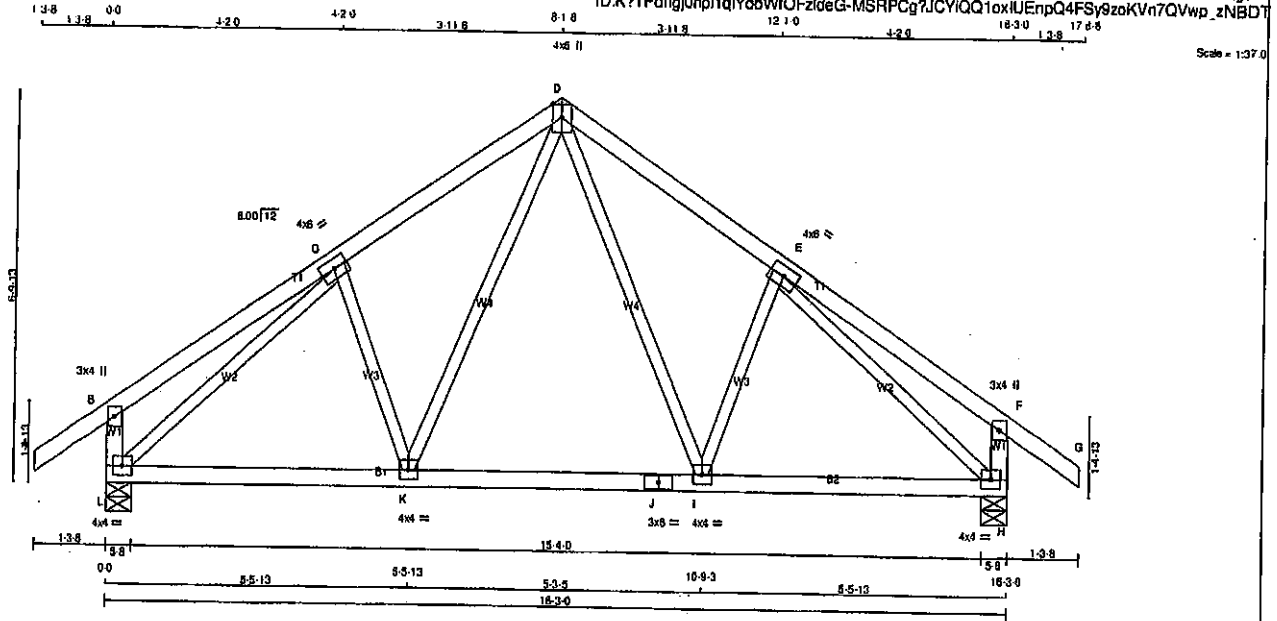

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
L - B	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
ALL WEBS		2x3	DRY	No.2	SPF
EXCFT					

EXCEPT

PLATES (tablets in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0			
C	TMWW-t	MT20	4.0	8.0			
D	TTWW+p	MT20	4.0	8.0			Edge
E	TMWW-t	MT20	4.0	8.0			
F	TMV+p	MT20	3.0	4.0			
H	BMWW1-t	MT20	4.0	4.0			
I	BMWW-t	MT20	4.0	4.0			
J	BS-t	MT20	3.0	6.0			
K	BMWW-t	MT20	4.0	4.0			
L	BMWW1-t	MT20	4.0	4.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
L	VERT	DOWN	IN-SX	IN-SX
H	1022 0	1022 0	5-8	5-8

UNFACTORED REACTIONS	1ST CASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
L	720	488 / 0 0 / 0 0 / 0 234 / 0 0 / 0
H	720	488 / 0 0 / 0 0 / 0 234 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	UNBRAC	MEMB.	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. (PLF)	FROM TO	CSI (LC)	UNBRAC LENGTH	FR-TO	FORCE (LBS)	MAX CSI (LC)
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	D-I	0 / 336	0.08 (1)
B-C	0 / 24	-91.8	-91.8	0.24 (1)	10.00	I-E	-217 / 0	0.06 (1)
C-D	-845 / 0	-91.8	-91.8	0.19 (1)	8.25	K-D	0 / 336	0.08 (1)
D-E	-845 / 0	-91.8	-91.8	0.19 (1)	6.25	C-K	-217 / 0	0.06 (1)
E-F	0 / 24	-91.8	-91.8	0.24 (1)	10.00	L-C	-1042 / 0	0.52 (1)
F-G	0 / 35	-91.8	-91.8	0.12 (1)	10.00	E-H	-1042 / 0	0.52 (1)
L-B	-268 / 0	0.0	0.0	0.03 (1)	7.81			
H-F	-268 / 0	0.0	0.0	0.03 (1)	7.81			
L-K	0 / 782	-18.5	-18.5	0.19 (1)	10.00			
K-J	0 / 557	-18.5	-18.5	0.17 (4)	10.00			
J-I	0 / 557	-18.5	-18.5	0.17 (4)	10.00			
I-H	0 / 782	-18.5	-18.5	0.19 (1)	10.00			

TOTAL WEIGHT = 2 X 72 = 145 lb [M/F]

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

OS: TC=0.24/1.00 (B-C:1), BC=0.19/1.00 (H-I:1),
WB=0.52/1.00 (C-L:1), SSI=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (H) (INPUT = 0.80)
JSI METAL = 0.29 (L) (INPUT = 1.00)




Structural component only
DWG# T-2007156

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T30A	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 28 2019 MTek Industries, Inc. Sat Apr 26 12:48:37 2020 Page 1
ID:K?TPdhgJ0nplfqYdbWIOFzIdeG-qe?nP00xzrqH2AN78CUMedQCLVGXo_wL4FTLQzNBDS

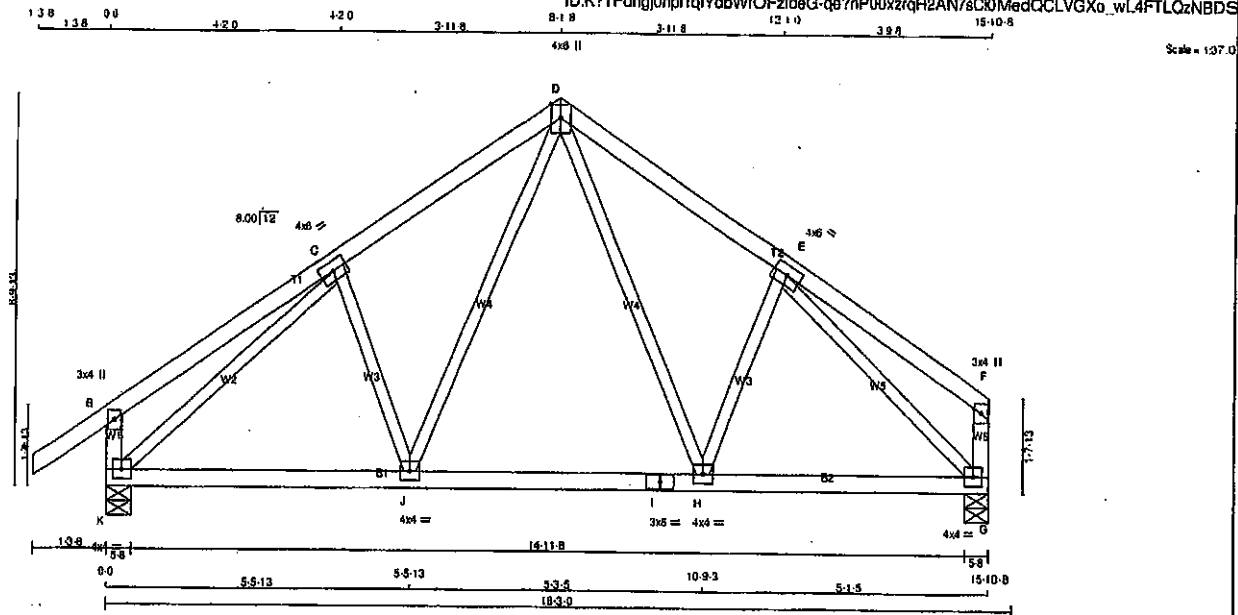

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
K - 8	2x4	DRY	No.2
G - F	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMV-p	MT20	3.0	4.0
C	TMWW-p	MT20	4.0	8.0
D	TTWW-p	MT20	4.0	8.0
E	TMWW-p	MT20	4.0	8.0
F	TMV-p	MT20	3.0	4.0
G	BMVW1-p	MT20	4.0	4.0
H	BMVW1-p	MT20	4.0	4.0
I	BS-1	MT20	3.0	6.0
J	BMVW1-p	MT20	4.0	4.0
K	BMVW1-p	MT20	4.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	UP	BRG	BRG	IN-SX	IN-SX
K	1001	0	0	1001	0	0	5-8	5-8	5-8
G	875	0	0	875	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST LOASE	MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	708	478 / 0	0 / 0	0 / 0	0 / 0	229 / 0	0 / 0
G	619	406 / 0	0 / 0	0 / 0	0 / 0	213 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE	FACTORED	MAX	MEMB.	FORCE	FACTORED	MAX
	(LBS)	VERT. LOAD	LC1 MAX		(LBS)	VERT. LOAD	LC1 MAX
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	D-H	0 / 272
B-C	0 / 24	-91.8	-91.8	0.24 (1)	10.00	H-E	-160 / 2
C-D	-917 / 0	-91.8	-91.8	0.19 (1)	6.25	J-D	0 / 342
D-E	-783 / 0	-91.8	-91.8	0.18 (1)	6.25	C-J	-222 / 0
E-F	0 / 24	-91.8	-91.8	0.22 (1)	10.00	K-C	-1012 / 0
K-B	-288 / 0	0.0	0.0	0.03 (1)	7.81	E-G	-992 / 0
G-F	-124 / 0	0.0	0.0	0.01 (1)	7.81		
K-J	0 / 740	-18.5	-18.5	0.18 (1)	10.00		
J-I	0 / 531	-18.5	-18.5	0.17 (4)	10.00		
I-H	0 / 531	-18.5	-18.5	0.17 (4)	10.00		
H-G	0 / 591	-18.5	-18.5	0.17 (1)	10.00		

TOTAL WEIGHT = 2 X 70 = 140 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TRC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.53")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.53")
CALCULATED VERT. DEFL. (TL) = L/999 (0.04")

CSI: TC=0.24/1.00 (B-C:1), BC=0.18/1.00 (J-K:1), WB=0.51/1.00 (C-K:1), SS=0.15/1.00 (D-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP (DRY)	SHEAR	SECTION	
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 788	1987 1686

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.86 (K) (INPUT = 0.80)
JSI METAL = 0.28 (K) (INPUT = 1.00)




Structural component only
DWG# T-2007157

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408169	T30S	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:38 2020 Page 1
ID:K?TPdhgj0npl1qYd0WIOFzIdeG-lqZ9cM1Zk9y8gKyJQvGFvAbElmYGAW4ak_1uszNBDR

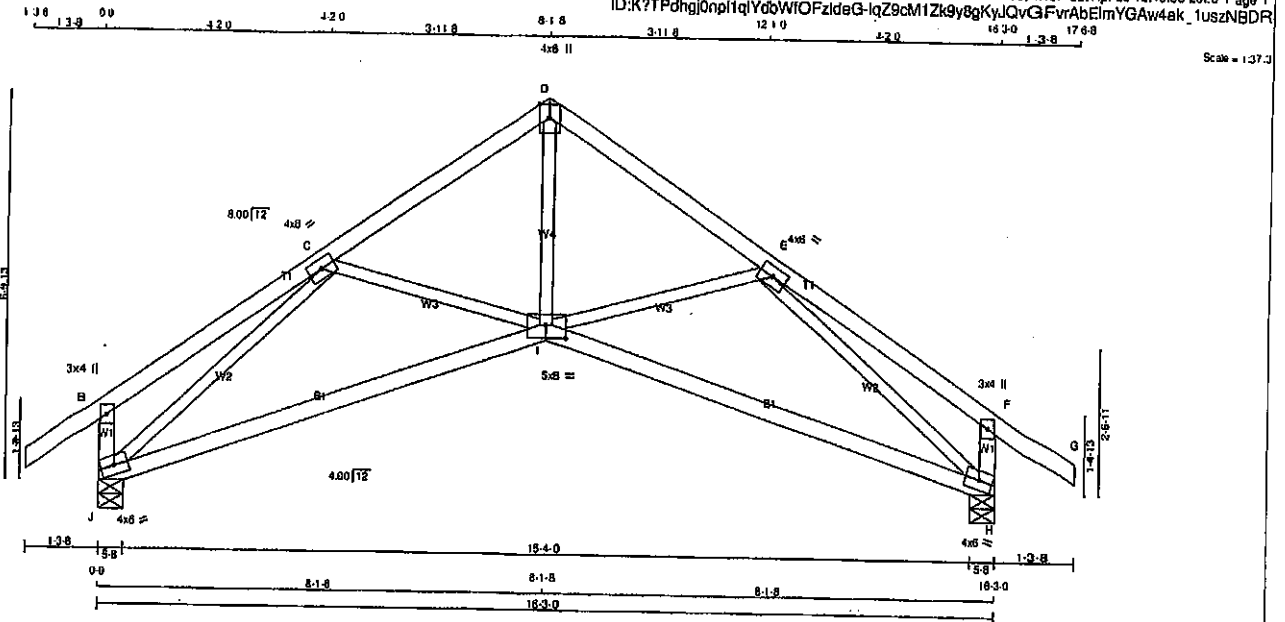

Scale = 1/32

LUMBER			
N. L. G. A. RULES	SIZE	DRY	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - 8	2x4	DRY	No.2
H - F	2x4	DRY	No.2
J - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMVW-t	MT20	4.0	8.0	
D	TTW+p	MT20	4.0	8.0	Edge
E	TMVW-t	MT20	4.0	8.0	
F	TMV+p	MT20	3.0	4.0	
H	BMVW-t	MT20	4.0	8.0	
I	BBVWVW-p	MT20	5.0	8.0	2.75 4.00
J	BMVW-t	MT20	4.0	8.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	BRG	IN-SX	IN-SX
J	1022	0	1022	0	0	5-8	5-8		
H	1022	0	1022	0	0	5-8	5-8		

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	720	488 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0
H	720	488 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.76 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	F-D	0 / 942	0.21 (1)	
B-C	0 / 22	-91.8	-91.8 0.22 (1)	F-E	-143 / 11	0.05 (1)	
C-D	-1134 / 0	-91.8	-91.8 0.19 (1)	C-I	-143 / 11	0.05 (1)	
D-E	-1134 / 0	-91.8	-91.8 0.19 (1)	J-C	-1478 / 0	0.78 (1)	
E-F	0 / 22	-91.8	-91.8 0.22 (1)	E-H	-1478 / 0	0.78 (1)	
F-G	0 / 35	-91.8	-91.8 0.12 (1)				
J-B	-273 / 0	0.0	0.0 0.03 (1)				
H-F	-273 / 0	0.0	0.0 0.03 (1)				
J-I	0 / 1120	-18.5	-18.5 0.44 (4)				
I-H	0 / 1120	-18.5	-18.5 0.44 (4)				

TOTAL WEIGHT = 2 X 67 = 133 LB (M)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 085-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.54")
CALCULATED VERT. DEFL (LL) = L/999 (0.05")
ALLOWABLE DEFL. (TL) = L/360 (0.54")
CALCULATED VERT. DEFL. (TL) = L/789 (0.25")

CSI: TC=0.22/1.00 (E-F:1), BC=0.44/1.00 (H-I:4), WB=0.78/1.00 (C-J:1), SSI=0.15/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP (DRY)	SHEAR	SECTION	
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (H) (INPUT = 0.90)
JSI METAL= 0.35 (H) (INPUT = 1.00)



Structural component only
DWG# T-2007158

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T32S	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 12:49:40 2020 Page 1	

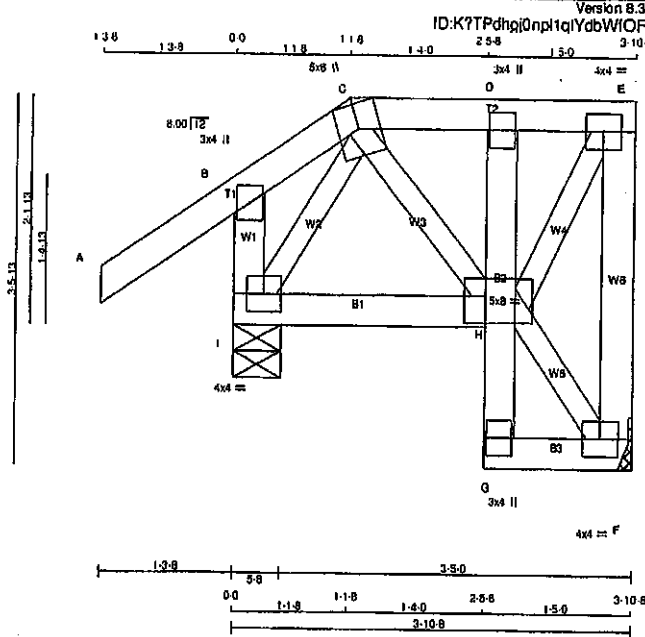

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
I - K	2x4	DRY	No.2	SPF
K - L	2x4	DRY	No.2	SPF
L - M	2x4	DRY	No.2	SPF
M - N	2x4	DRY	No.2	SPF
N - O	2x4	DRY	No.2	SPF
O - P	2x4	DRY	No.2	SPF
P - Q	2x4	DRY	No.2	SPF
Q - R	2x4	DRY	No.2	SPF
R - S	2x4	DRY	No.2	SPF
S - T	2x4	DRY	No.2	SPF
T - U	2x4	DRY	No.2	SPF
U - V	2x4	DRY	No.2	SPF
V - W	2x4	DRY	No.2	SPF
W - X	2x4	DRY	No.2	SPF
X - Y	2x4	DRY	No.2	SPF
Y - Z	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0			
C	TTWW+m	MT20	5.0	8.0	Edge		
D	TMV+p	MT20	3.0	4.0			
E	TMVW-i	MT20	4.0	4.0			
F	BMVW-i	MT20	4.0	4.0			
G	BMV+p	MT20	3.0	4.0			
H	BMVWVW-i	MT20	5.0	8.0	3.00	2.50	
I	BMVW-i	MT20	4.0	4.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	IN-SX	IN-SX
F	191	0	0	MECHANICAL
I	382	0	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	138	87/-12	0/0	0/0	0/0	49/0	0/0
I	253	182/0	0/0	0/0	0/0	71/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0/35	-91.8	-91.8 0.14 (5)	10.00	C-H	0/80	0.00 (1)
B-C	-41/0	-91.8	-91.8 0.13 (5)	6.25	H-F	-7/0	0.00 (1)
C-D	-89/0	-91.8	-91.8 0.02 (1)	6.25	H-E	0/153	0.03 (1)
D-E	-86/0	-91.8	-91.8 0.02 (1)	6.25	I-C	-100/34	0.02 (1)
E-F	-175/0	0.0	0.0 0.03 (1)	7.81			
F-B	-253/0	0.0	0.0 0.03 (1)	7.81			
I-H	-18/53	-18.5	-18.5 0.04 (4)	6.25			
G-H	0/13	0.0	0.0 0.01 (1)	10.00			
H-D	-142/0	0.0	0.0 0.01 (1)	7.81			
G-F	0/5	-18.5	-18.5 0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 25 lb

DESIGN CRITERIA:

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/989 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/989 (0.00")

CSI: TC=0.14/1.00 (A-B:5), BC=0.04/1.00 (H-I:4), WB=0.03/1.00 (E-H:1), SSI=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1567 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (E) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007160

JOB NAME 408169	TRUSS NAME T33	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tannerack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:41 2020 Page 1
ID:K?TPdngj0npl1qYdbWfOfzIdeG-IPFIFO3S14LjXohu51pyWUo8MznVTaTWGIDhUBzNBDDC

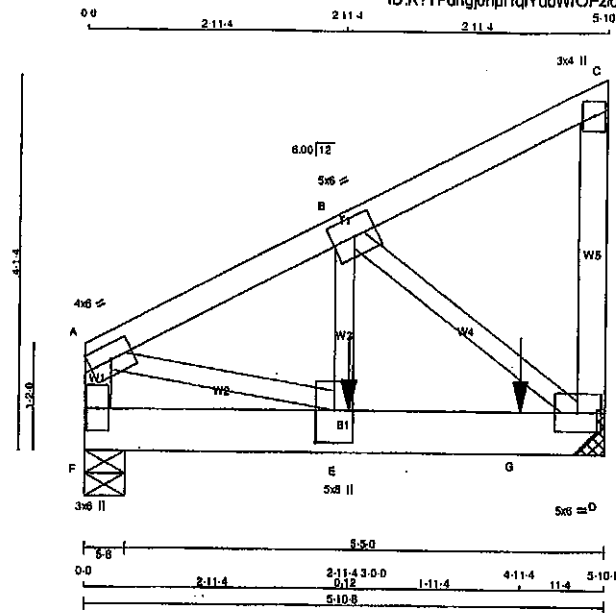

Scale = 1/23.3

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
F - A	2x4	DRY	No.2	SPF		
A - C	2x4	DRY	No.2	SPF		
D - C	2x4	DRY	No.2	SPF		
F - D	2x5	DRY	No.2	SPF		

ALL WEBS 2x3 DRY
DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F-A 1	12	TOP
A-C 1	12	TOP
C-D 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F-D 2	8	SIDE (305.2)
WEBS : (0.122"x3") SPIRAL NAILS		
B-E 1	2	SIDE (408.8)
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	4.0	8.0		Edge
B	TMVW-1	MT20	5.0	8.0		
C	TMVW-1	MT20	3.0	4.0		
D	BMVW-1	MT20	5.0	8.0		
E	BMVW-1	MT20	5.0	8.0	4.25	2.50

DIMENSIONS, SUPPORTS, AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
F	1914	0	1914	0
D	2859	0	2859	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	SNOW	MAX/MIN. LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	1348	915/0	0/0	0/0	0/0	434/0	0/0
D	2015	1359/0	0/0	0/0	0/0	657/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.59 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO						FR-TO			
F-A	-1877/0	0.0	0.0	0.10 (1)	7.81	A-E	0/2380	0.29 (1)	
A-B	-2566/0	-91.8	-91.8	0.08 (1)	5.59	E-B	0/2608	0.32 (1)	
B-C	-7/0	-91.8	-91.8	0.06 (1)	10.00	B-D	-2896/0	0.35 (1)	
D-C	-120/0	0.0	0.0	0.01 (1)	7.81				
F-E	0/0	-18.5	-18.5	0.01 (1)	10.00				
E-G	0/2301	-18.5	-18.5	0.49 (1)	10.00				
G-D	0/2301	-18.5	-18.5	0.49 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	3-0-0	-2737	-2737	---	BACK	VERT	TOTAL	---	C1
G	4-11-4	-1388	-1388	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 29 = 58 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TO=0.10/1.00 (A-F:1), BC=0.49/1.00 (D-E:1), WB=0.35/1.00 (B-D:1), SS=0.33/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.84 (B) (INPUT = 0.90)
JSI METAL = 0.44 (E) (INPUT = 1.00)



Structural component only
DWG# T-2007161 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T33	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 12:49:41 2020 Page 2
ID:K?TPdngl0npl1qYdbWfOFzdaG-iPFIF03S14LJXohu51pyWUo8MznVTaTWGiDhUBzNBDC


PLATES (table is in inches)
JT TYPE PLATES W LEN Y X
F BMV1+p MT20 3.0 6.0
Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2007161 3/2

JOB NAME 408170	TRUSS NAME T40	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 26 13:02:15 2020 Page 1			

ID:K7TPdhj0npl1qYd0WIOFzld0G-dToLVCBPTKKk_gKpGOLn4U0ubv6N8cfVf79ayUzNB1c
Scale: 1:57.3

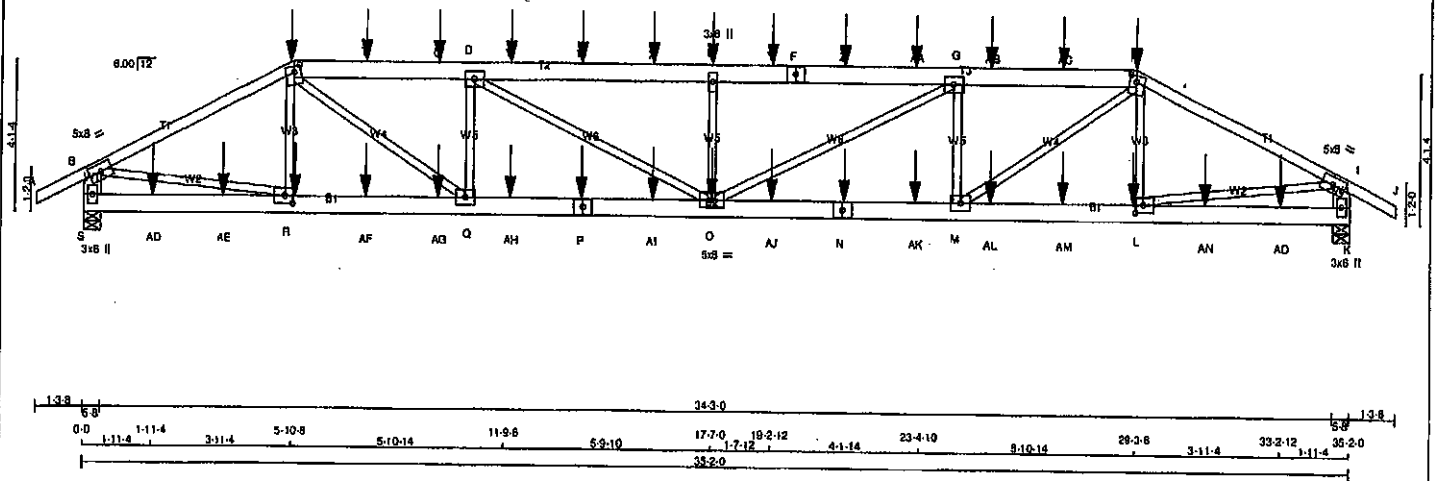

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - F	2x6	DRY	No.2
F - H	2x6	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x6	DRY	No.2
K - I	2x6	DRY	No.2
S - P	2x6	DRY	No.2
P - N	2x6	DRY	No.2
N - K	2x6	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C	12	SIDE(81.0)
H-J	12	SIDE(81.0)
C-F	2	SIDE(81.0)
F-H	2	SIDE(81.0)
S-B	2	TOP
K-I	2	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
S-P	2	SIDE(183.1)
P-N	2	SIDE(183.1)
N-K	2	SIDE(183.1)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORZ	BRG	BRG	IN-SX	IN-SX
S	3331	0	3331	0	0	5-8	5-8		
K	3331	0	3331	0	0	5-8	5-8		

UNFACTORED REACTIONS		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	2356	1544 / 0	0 / 0	0 / 0	0 / 0	812 / 0	0 / 0
K	2356	1544 / 0	0 / 0	0 / 0	0 / 0	812 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.87 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)	
CHORDS	FACTORED	WEBS	FACTORED
MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	0 / 28	R-C	-449 / 0
B-C	-5089 / 0	C-Q	0 / 3021
C-T	-6976 / 0	Q-D	-1608 / 0
T-U	-6976 / 0	D-O	0 / 1339
U-D	-6976 / 0	O-E	-1058 / 0
D-V	-8155 / 0	E-G	0 / 1339
V-W	-8155 / 0	G-H	-1608 / 0
W-X	-8155 / 0	H-I	0 / 3021
X-E	-8155 / 0	I-H	-449 / 0
E-Y	-8155 / 0	H-R	0 / 4585
Y-F	-8155 / 0	L-I	0 / 4585
F-Z	-8155 / 0		
Z-AA	-8155 / 0		
AA-G	-8155 / 0		
G-AB	-6976 / 0		
AB-AC	-6976 / 0		
AC-H	-6976 / 0		
H-I	-5089 / 0		
I-J	0 / 28		
S-B	-3250 / 0		
K-I	-3250 / 0		

CHORDS	FACTORED	WEBS	FACTORED
MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
S-AD	0 / 0		
AD-AE	0 / 0		
AE-R	0 / 0		
R-AF	0 / 4557		
AF-AG	0 / 4557		
AG-Q	0 / 4557		
Q-AH	0 / 8975		
AH-P	0 / 8975		
P-AI	0 / 8975		
AI-O	0 / 8975		
O-AJ	0 / 8975		
AJ-N	0 / 8975		
N-AK	0 / 8975		
AK-M	0 / 8975		
M-AL	0 / 4557		
AL-AM	0 / 4557		
AM-L	0 / 4557		
L-AN	0 / 0		
AN-AO	0 / 0		
AO-K	0 / 0		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CSI: TC=0.52/1.00 (B-C:1), BC=0.52/1.00 (O-Q:1),
WB=0.57/1.00 (B-R:1), SS=0.16/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (H) (INPUT = 0.90)
JSI METAL = 0.67 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007168 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T40	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 13:02:15 2020 Page 2
ID:K7TPdhi0npl1qYdbWOFzIdeG-dToLVCBPTkKk cKpGOLn4U0ubv6N8cfV7savUzNB1c

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	8.0		
C	TTWW+m	MT20	5.0	8.0	2.00	2.25
D	TMVW-t	MT20	5.0	8.0		
E	TMVW-w	MT20	3.0	8.0		
F	TS-t	MT20	5.0	8.0		
G	TMVW-t	MT20	5.0	8.0		
H	TTWW+m	MT20	5.0	8.0	2.00	2.25
I	TMVW-t	MT20	5.0	8.0		
K	BMV1+p	MT20	3.0	8.0		
L	BMVW-t	MT20	5.0	8.0	2.50	2.50
M	BMVW-t	MT20	5.0	8.0		
N	BS-t	MT20	5.0	8.0		
O	BMVWW-t	MT20	5.0	8.0		
P	BS-t	MT20	5.0	8.0		
Q	BMVW-t	MT20	5.0	8.0		
R	BMVW-t	MT20	5.0	8.0	2.50	2.50
S	BMV1+p	MT20	3.0	8.0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-437	-437	---	FRONT	VERT	TOTAL	---	C1
E	17-7-0	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	29-3-8	-437	-437	---	FRONT	VERT	TOTAL	---	C1
L	29-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
N	21-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
O	17-7-0	-28	-28	---	FRONT	VERT	TOTAL	---	C1
P	13-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	19-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	1-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AE	3-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AF	7-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AG	9-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AH	11-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AI	13-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AJ	19-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AK	23-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AL	25-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AM	27-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AN	31-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AO	33-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

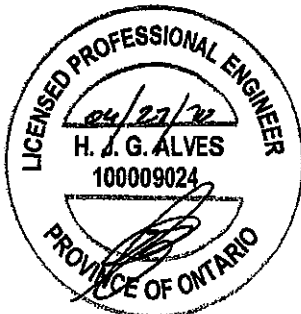

Structural component only
DWG# T-2007168

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T40Z	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington	Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 13:02:17 2020 Page 1
ID:K?TPdngl0npl1qYcbWOFzdeG-anw5vuDf_MaSDzUBNpNF9v6Bulk?cSGo6JLhONzNB1a	
13.8 0.0 5.10.8 3.10.8 2.0.12 2.11.4 2.8.0 1.10.2 11.9.4 2.9.10 17.7.0 3.9.10 33.4.10 5.10.14 29.3.8 5.10.8 35.2.0 38.5.8 1.3.8 1.3.8	Scale = 1:17.3

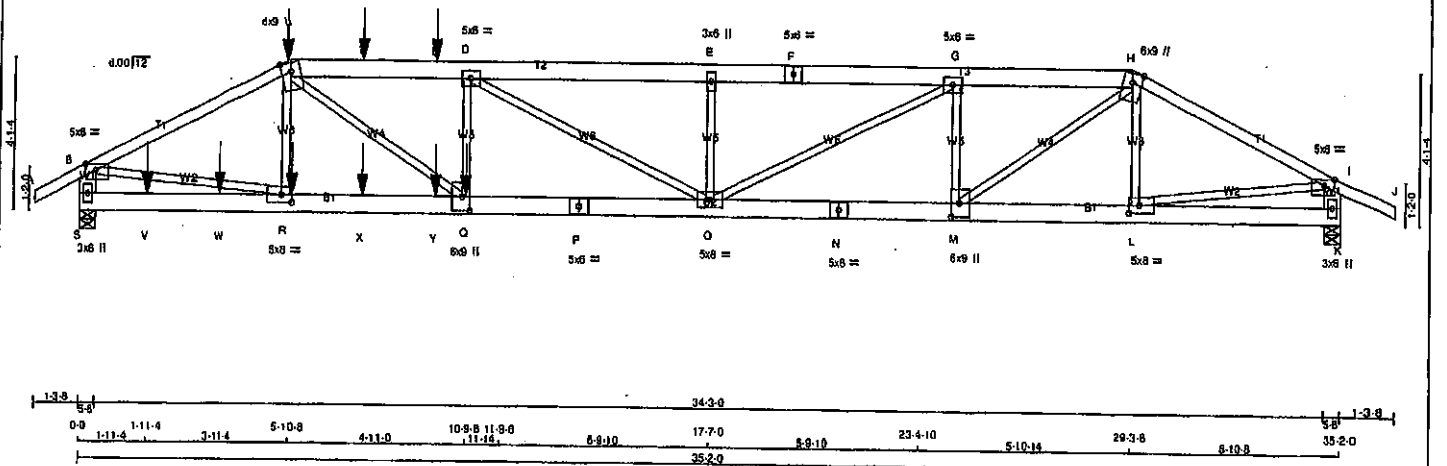

LUMBER				DESCR.			
N. L. G. A. RULES							
CHORDS SIZE LUMBER							
A - C	2x4	DRY	No.2	SPF			
C - F	2x6	DRY	No.2	SPF			
F - H	2x6	DRY	No.2	SPF			
H - J	2x4	DRY	No.2	SPF			
S - B	2x4	DRY	No.2	SPF			
K - I	2x6	DRY	No.2	SPF			
S - P	2x6	DRY	No.2	SPF			
P - N	2x6	DRY	No.2	SPF			
N - K	2x6	DRY	No.2	SPF			
ALL WEBS EXCEPT 2x3 DRY No.2				SPF			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-G 1	12	SIDE(61.0)
H-J 1	12	TOP
C-F 2	12	SIDE(61.0)
F-H 2	12	TOP
S-B 2	12	TOP
K-I 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S-P 2	12	SIDE(183.1)
P-N 2	12	TOP
N-K 2	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	
D-Q 1	3	SIDE(525.1)
G-M 1	3	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
		VERT	HORZ	DOWN	HORZ	UPLIFT	N-SX	IN-SX	
JT		4582	0	4582	0	0	5-8	5-8	
S		3047	0	3047	0	0	5-8	5-8	

UNFACTORED REACTIONS

1ST LOASE MAX/MIN. COMPONENT REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	3238	2151 / 0	0 / 0	0 / 0	0 / 0	1084 / 0	0 / 0
K	2151	1436 / 0	0 / 0	0 / 0	0 / 0	715 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.15 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRAC LENGTH (LC)	MEMB.		MAX. FACTORED FORCE (LBS)
FR-TO			FROM TO		FR-TO		
A-B	0 / 28	-91.8	-91.8 0.07 (1)	10.00	R-C	-673 / 0	0.08 (1)
B-C	-7283 / 0	-91.8	-91.8 0.72 (1)	3.15	C-Q	0 / 4986	0.62 (1)
C-T	-10549 / 0	-91.8	-91.8 0.34 (1)	3.66	Q-D	-184 / 38	0.02 (1)
T-U	-10549 / 0	-91.8	-91.8 0.34 (1)	3.55	D-O	-1207 / 0	0.72 (1)
U-D	-10549 / 0	-91.8	-91.8 0.34 (1)	3.66	O-E	-946 / 0	0.08 (1)
D-E	-9485 / 0	-91.8	-91.8 0.31 (1)	3.78	O-G	0 / 2871	0.36 (1)
E-F	-9485 / 0	-91.8	-91.8 0.29 (1)	3.81	M-G	-1984 / 0	0.24 (1)
F-G	-9485 / 0	-91.8	-91.8 0.29 (1)	3.81	M-H	0 / 3512	0.43 (1)
G-H	-9698 / 0	-91.8	-91.8 0.17 (1)	4.44	L-H	-464 / 0	0.06 (1)
H-I	-4808 / 0	-91.8	-91.8 0.48 (1)	4.08	B-R	0 / 8596	0.82 (1)
I-J	0 / 28	-91.8	-91.8 0.07 (1)	10.00	L-I	0 / 4167	0.52 (1)
S-B	-4503 / 0	0.0	0.0 0.16 (1)	6.78			
K-I	-2990 / 0	0.0	0.0 0.11 (1)	7.81			

S-V	0 / 0	-18.5	-18.5 0.06 (4)	10.00
V-W	0 / 0	-18.5	-18.5 0.06 (4)	10.00
W-R	0 / 0	-18.5	-18.5 0.06 (4)	10.00
R-X	0 / 8557	-18.5	-18.5 0.50 (1)	10.00
X-Y	0 / 8557	-18.5	-18.5 0.50 (1)	10.00
Y-Q	0 / 8557	-18.5	-18.5 0.50 (1)	10.00
Q-P	0 / 10648	-18.5	-18.5 0.77 (1)	10.00
P-O	0 / 10648	-18.5	-18.5 0.77 (1)	10.00
O-N	0 / 6955	-18.5	-18.5 0.50 (1)	10.00
N-M	0 / 6955	-18.5	-18.5 0.50 (1)	10.00
M-L	0 / 4144	-18.5	-18.5 0.29 (1)	10.00
L-K	0 / 0	-18.5	-18.5 0.04 (4)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10.8	-437	-437	---	BACK	VERT	TOTAL	---	C1
Q	10-9.8	-2715	-2715	---	BACK	VERT	TOTAL	---	C1
R	5-11.4	-26	-26	---	BACK	VERT	TOTAL	---	C1
T	7-11.4	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	9-11.4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	1-11.4	-26	-26	---	BACK	VERT	TOTAL	---	C1
W	3-11.4	-26	-26	---	BACK	VERT	TOTAL	---	C1
X	7-11.4	-26	-26	---	BACK	VERT	TOTAL	---	C1
Y	9-11.4	-26	-26	---	BACK	VERT	TOTAL	---	C1

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.26")
 ALLOWABLE DEFL.(TL)= L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/881 (0.48")
 CSI: TC=0.72/1.00 (B-C:1), BC=0.77/1.00 (C-Q:1),
 WB=0.82/1.00 (B-R:1), SS=0.13/1.00 (C-D:1)
 DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1667 768 1987 1656	

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.90)
 JSI METAL= 0.99 (P) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRAWG NO.
408170	T40Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 13:02:17 2020 Page 2
ID:K?TPdhai0npl1qYdbWIOFzIdG-anv5vuDf MaSDzUBNpNF9v6Buik?cSGo6JLh0NzNB1a

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	2.00	3.50
C	TTWW+m	MT20	6.0	9.0	Edge	
D	TMWW-t	MT20	5.0	6.0		
E	TMW+w	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMWW-t	MT20	5.0	6.0		
H	TTWW+m	MT20	6.0	9.0	Edge	
I	TMVW-p	MT20	5.0	8.0	2.00	3.50
K	BMV1+p	MT20	3.0	6.0		
L	BMWW-t	MT20	5.0	8.0	2.50	3.25
M	BMWW-t	MT20	6.0	9.0	4.50	2.50
N	BS-t	MT20	5.0	6.0		
O	BMWW-t	MT20	5.0	8.0		
P	BS-t	MT20	5.0	6.0		
Q	BMWW-t	MT20	6.0	9.0	4.50	2.50
R	BMWW-t	MT20	5.0	8.0	2.50	3.25
S	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007169 3/2

JOB NAME 408170	TRUSS NAME T41	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Set Apr 25 13:02:18 2020 Page 1
ID:K7TPdng0npl1qYdbWIOFzIdG-22U77EDHfJr73OxWwU16eJ865BLyLxLz4FZpNB1Z

1-3.8 0-0 4-0.8 4-0.8 3-10.0 7-10.8 8-6.1 14-4.9 8-4.1 20-9.7 8-6.1 27-3.8 3-10.0 3-1.8 4-0.8 35-2.0 36-5.8
Scale = 1:57.2

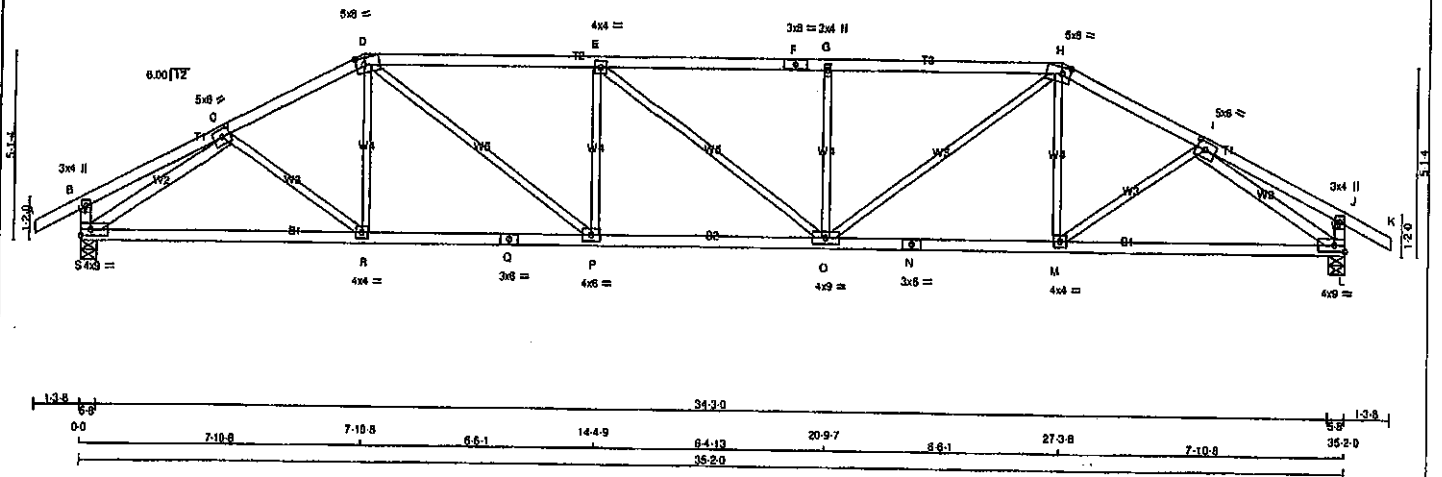

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV-p	MT20	3.0	4.0	
C	TMVW-1	MT20	5.0	6.0	250 2.75
D	TMVW-m	MT20	5.0	8.0	225 2.75
E	TS-1	MT20	4.0	4.0	
F	TS-1	MT20	3.0	8.0	
G	TMVW-w	MT20	2.0	4.0	
H	TMVW-m	MT20	5.0	6.0	225 2.75
I	TMVW-1	MT20	5.0	6.0	250 2.75
J	TMV-p	MT20	3.0	4.0	
L	BMVW-1	MT20	4.0	9.0	Edge
M	BMVW-1	MT20	4.0	4.0	
N	BS-1	MT20	3.0	6.0	
O	BMVW-1	MT20	4.0	9.0	
P	BMVW-1	MT20	4.0	6.0	
Q	BS-1	MT20	3.0	6.0	
R	BMVW-1	MT20	4.0	4.0	
S	BMVW-1	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED				MAXIMUM FACTORED			
GROSS REACTION				GROSS REACTION			
JT	VERT	HORZ		DOWN	HORZ	UPLIFT	
S	2063	0		2063	0	0	5-8
L	2063	0		2063	0	0	5-8

UNFACTORED REACTIONS							
1ST LCASE				MAX./MIN. COMPONENT REACTIONS			
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.94 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-91.8 -91.8	0.12 (1)	10.00	C-R	0 / 93	0.03 (4)
B-C	0 / 16	-91.8 -91.8	0.20 (1)	10.00	R-D	0 / 121	0.04 (4)
C-D	-2799 / 0	-91.8 -91.8	0.32 (1)	3.88	D-P	0 / 1267	0.29 (1)
D-E	-3508 / 0	-91.8 -91.8	0.95 (1)	2.94	P-E	-643 / 0	0.25 (1)
E-F	-3507 / 0	-91.8 -91.8	0.93 (1)	2.94	E-O	-2 / 0	0.00 (1)
F-G	-3507 / 0	-91.8 -91.8	0.93 (1)	2.94	O-G	-643 / 0	0.25 (1)
G-H	-3507 / 0	-91.8 -91.8	0.94 (1)	2.95	O-H	0 / 1268	0.28 (1)
H-I	-2799 / 0	-91.8 -91.8	0.32 (1)	3.88	M-H	0 / 121	0.04 (4)
I-J	0 / 16	-91.8 -91.8	0.20 (1)	10.00	M-I	0 / 93	0.03 (4)
J-K	0 / 28	-91.8 -91.8	0.12 (1)	10.00	S-C	-2974 / 0	0.83 (1)
S-B	-270 / 0	0.0 0.0	0.03 (1)	7.81	I-L	-2974 / 0	0.83 (1)
L-J	-270 / 0	0.0 0.0	0.03 (1)	7.81			
S-R	0 / 2417	-18.5 -18.5	0.53 (1)	10.00			
R-Q	0 / 2489	-18.5 -18.5	0.54 (1)	10.00			
Q-P	0 / 2489	-18.5 -18.5	0.54 (1)	10.00			
P-O	0 / 3505	-18.5 -18.5	0.84 (1)	10.00			
O-N	0 / 2489	-18.5 -18.5	0.54 (1)	10.00			
N-M	0 / 2489	-18.5 -18.5	0.54 (1)	10.00			
M-L	0 / 2417	-18.5 -18.5	0.53 (1)	10.00			

TOTAL WEIGHT = 2 X 139 = 278 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (L) = L/360 (1.17")
CALCULATED VERT. DEFL. (L) = L/999 (0.21")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.41")

CSK: TC=0.85/1.00 (D-E:1), BC=0.84/1.00 (O-P:1), WB=0.83/1.00 (L:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PL)	SECTION (PL)
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788
		1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.89 (L) (INPUT = 0.80)
JSI METAL= 0.77 (N) (INPUT = 1.00)



Structural component only
DWG# T-2007170

JOB NAME 408170	TRUSS NAME T42	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:19 2020 Page 1
 ID:K?TPdngi0npl1qIYdbWIOFzIdeG-WE2rKaEwWzr9THdaVEQIEKBSUWUW4PP4adco5FzNB1Y
 Scale = 1/8" = 1'-0"

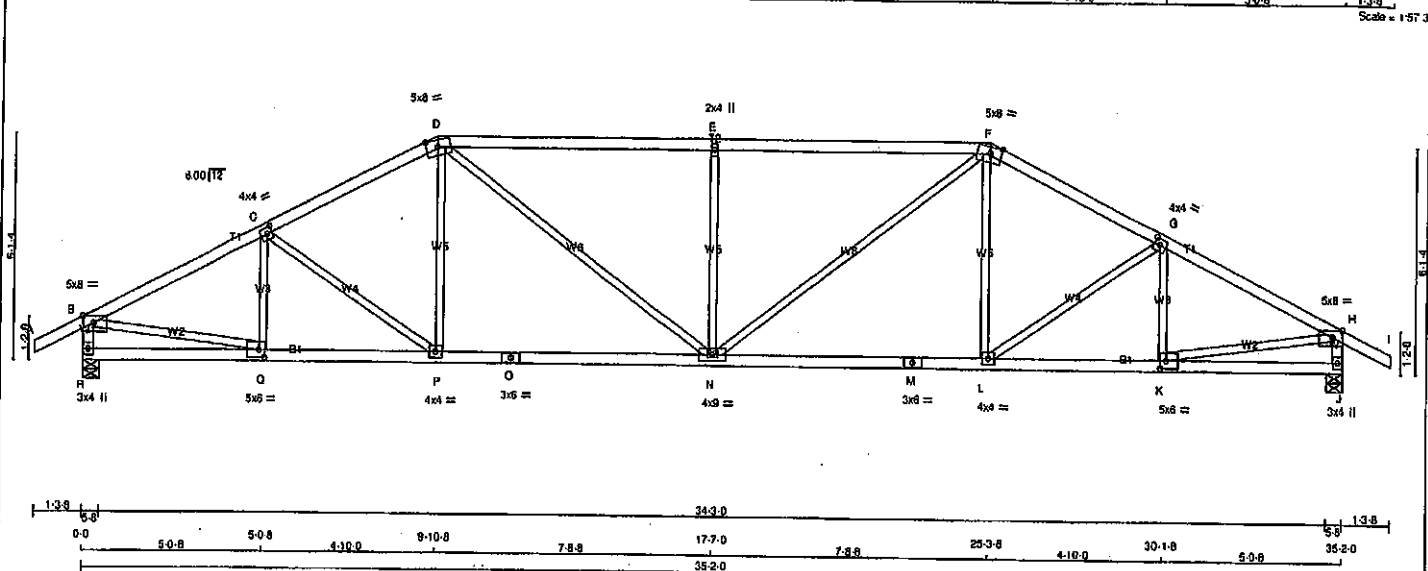

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	8.0	Edge	3.50
C	TMWV-t	MT20	4.0	4.0	2.00	1.75
D	TTWV-m	MT20	5.0	8.0	2.25	3.75
E	TMWV-w	MT20	2.0	4.0		
F	TTWV-m	MT20	5.0	8.0	2.25	3.75
G	TMWV-t	MT20	4.0	4.0	2.00	1.75
H	TMWV-p	MT20	5.0	8.0	Edge	3.50
J	BMV1-p	MT20	3.0	4.0		
K	BMWV-t	MT20	5.0	6.0	2.50	2.00
L	BMWV-t	MT20	4.0	4.0		
M	BS-t	MT20	3.0	6.0		
N	BMWVW-t	MT20	4.0	4.0		
O	BS-t	MT20	3.0	6.0		
P	BMWV-t	MT20	4.0	4.0		
Q	BMWV-t	MT20	5.0	6.0	2.50	2.00
R	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ
JT	2063	0	2063	0
R	2063	0	2063	0
J	2063	0	2063	0

UNFACTORED REACTIONS

1ST CASE	MAX	MIN	COMPONENT REACTIONS
JT	1457	989 / 0	0 / 0
R	1457	989 / 0	0 / 0
J	1457	989 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.75 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	Q-C	-353 / 0	10.00	0.08 (1)
B-C	-2834 / 0	-91.8	-91.8 0.39 (1)	C-P	-210 / 0	3.81	0.13 (1)
C-D	-2887 / 0	-91.8	-91.8 0.37 (1)	P-D	0 / 246	3.91	0.08 (4)
D-E	-3060 / 0	-91.8	-91.8 0.97 (1)	D-N	0 / 844	2.78	0.19 (1)
E-F	-3060 / 0	-91.8	-91.8 0.97 (1)	N-E	-872 / 0	2.78	0.51 (1)
F-G	-2887 / 0	-91.8	-91.8 0.37 (1)	N-F	0 / 844	3.91	0.19 (1)
G-H	-2834 / 0	-91.8	-91.8 0.39 (1)	L-F	0 / 246	3.81	0.06 (4)
H-I	0 / 28	-91.8	-91.8 0.12 (1)	L-G	-210 / 0	10.00	0.13 (1)
R-B	-2018 / 0	0.0	0.0 0.20 (1)	K-G	-353 / 0	5.84	0.08 (1)
J-H	-2018 / 0	0.0	0.0 0.20 (1)	B-Q	0 / 2591	5.84	0.58 (1)
R-Q	0 / 0	-18.5	-18.5 0.10 (4)	K-H	0 / 2591	5.84	0.58 (1)
Q-P	0 / 2555	-18.5	-18.5 0.51 (1)				
P-O	0 / 2388	-18.5	-18.5 0.49 (1)				
O-N	0 / 2388	-18.5	-18.5 0.49 (1)				
N-M	0 / 2388	-18.5	-18.5 0.49 (1)				
M-L	0 / 2388	-18.5	-18.5 0.49 (1)				
L-K	0 / 2555	-18.5	-18.5 0.51 (1)				
K-J	0 / 0	-18.5	-18.5 0.10 (4)				

TOTAL WEIGHT = 2 X 139 = 277 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2010
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.17")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.34")

CSI: TC=0.97/1.00 (D-E:1), BC=0.51/1.00 (P-Q:1), WB=0.58/1.00 (B-Q:1), SS=0.34/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	610 354 1667 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (F) (INPUT = 0.90)

JSI METAL = 0.75 (M) (INPUT = 1.00)

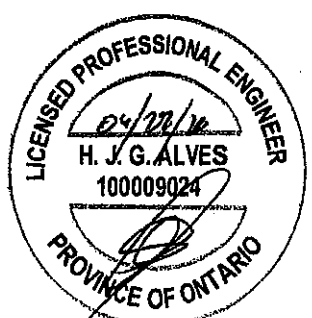


Structural component only
 DWG# T-2007171

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T43	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:20 2020 Page 1
ID:K?TPdngJnpl1q/YdbWtOFzldG- QcEYwFYHHz04RCm3xxynXkjMwq0psVEoH2LdizNB1X

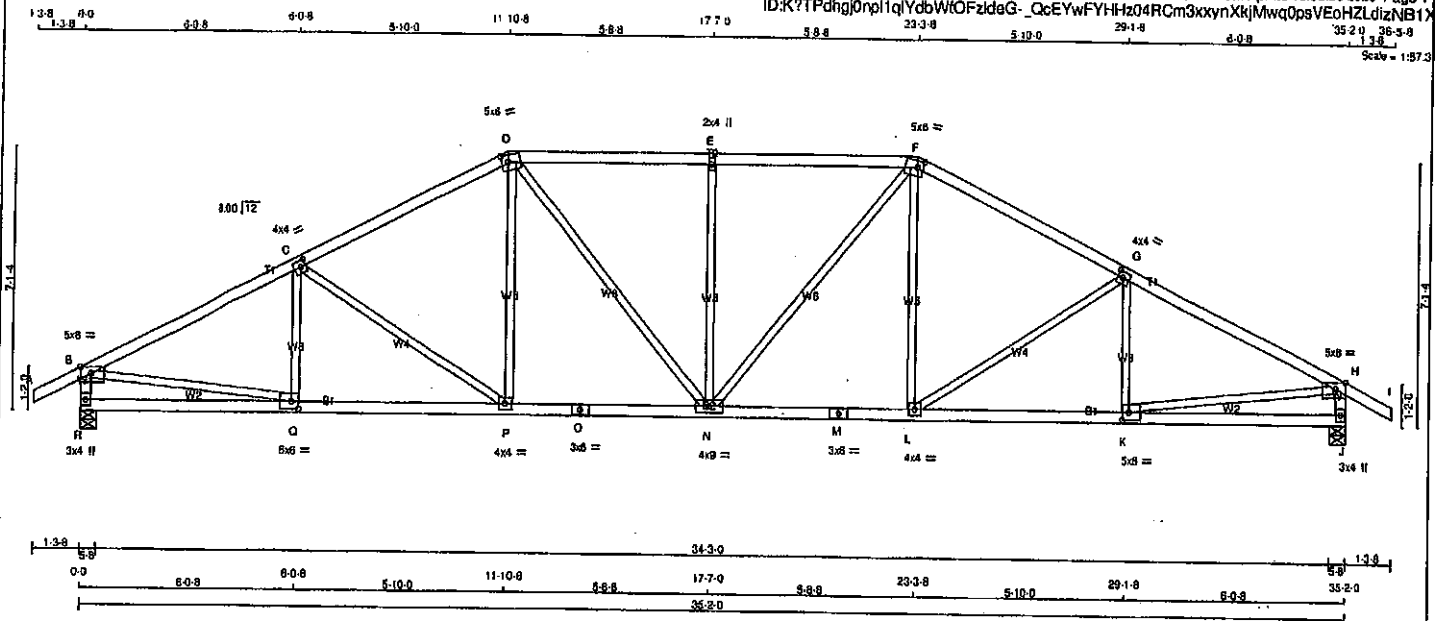

LUMBER				N. L. G. A. RULES	
CHORDS	SIZE	LUMBER	DESCR.		
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
R - B	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
R - O	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
DRY, SEASONED LUMBER.					

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	8.0	Edge 3.50
C	TMVW-l	MT20	4.0	4.0	2.00 1.75
D	TTWW-m	MT20	5.0	6.0	2.25 2.00
E	TMVW-w	MT20	2.0	4.0	
F	TTWW-m	MT20	5.0	8.0	2.25 2.00
G	TMVW-l	MT20	4.0	4.0	2.00 1.75
H	TMVW-p	MT20	5.0	8.0	Edge 3.50
J	BMVW-l	MT20	3.0	4.0	
K	BMVW-l	MT20	5.0	6.0	2.60 2.25
L	BMVW-l	MT20	4.0	4.0	
M	BS-l	MT20	3.0	8.0	
N	BMVW-w	MT20	4.0	9.0	
O	BS-l	MT20	3.0	8.0	
P	BMVW-l	MT20	4.0	4.0	
Q	BMVW-l	MT20	5.0	8.0	2.50 2.25
R	BMV-l-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
R	2063	0	2063	0	0	5-8	5-8	5-8	5-8
J	2063	0	2063	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS								
JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL		
R	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0		
J	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-91.8 -91.8	0.12 (1)	10.00	Q-C	-255 / 12	0.07 (1)
B-C	-2889 / 0	-91.8 -91.8	0.58 (1)	3.58	C-P	-435 / 0	0.42 (1)
C-D	-2539 / 0	-91.8 -91.8	0.52 (1)	3.83	P-D	0 / 360	0.08 (1)
D-E	-2539 / 0	-91.8 -91.8	0.48 (1)	3.85	D-N	0 / 482	0.11 (1)
E-F	-2539 / 0	-91.8 -91.8	0.48 (1)	3.85	N-E	-641 / 0	0.56 (1)
F-G	-2539 / 0	-91.8 -91.8	0.52 (1)	3.83	N-F	0 / 482	0.11 (1)
G-H	-2889 / 0	-91.8 -91.8	0.58 (1)	3.58	L-F	0 / 350	0.08 (1)
H-I	0 / 28	-91.8 -91.8	0.12 (1)	10.00	L-G	-435 / 0	0.42 (1)
R-B	-2014 / 0	0.0 0.0	0.20 (1)	5.95	K-G	-255 / 12	0.07 (1)
J-H	-2014 / 0	0.0 0.0	0.20 (1)	5.95	B-Q	0 / 2635	0.59 (1)
					K-H	0 / 2635	0.59 (1)
R-Q	0 / 0	-18.5 -18.5	0.15 (4)	10.00			
Q-P	0 / 2809	-18.5 -18.5	0.48 (1)	10.00			
P-O	0 / 2249	-18.5 -18.5	0.43 (1)	10.00			
O-N	0 / 2249	-18.5 -18.5	0.43 (1)	10.00			
N-M	0 / 2249	-18.5 -18.5	0.43 (1)	10.00			
M-L	0 / 2249	-18.5 -18.5	0.43 (1)	10.00			
L-K	0 / 2809	-18.5 -18.5	0.48 (1)	10.00			
K-J	0 / 0	-18.5 -18.5	0.15 (4)	10.00			

TOTAL WEIGHT = 2 X 145 = 289 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 0.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = L/999 (0.15)
ALLOWABLE DEFL.(TL) = L/360 (1.17)
CALCULATED VERT. DEFL.(TL) = L/999 (0.28)
CSI: TC=0.58(1.00 (B-C:1), BC=0.48(1.00 (P-Q:1), WB=0.59(1.00 (B-Q:1), SSI=0.25(1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1867 788	1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.89 (Q) (INPUT = 0.90)
JSI METAL= 0.69 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007172

JOB NAME 408170	TRUSS NAME T44	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 28 13:02:21 2020 Page 1	
ID:K?TPdhqj0npl1qYdbW/OFzIdeG-SdAdGGA2a5tibnycISBKIGrDK9jYJhN1xJv98zNB1W				Scale = 1:50.0	

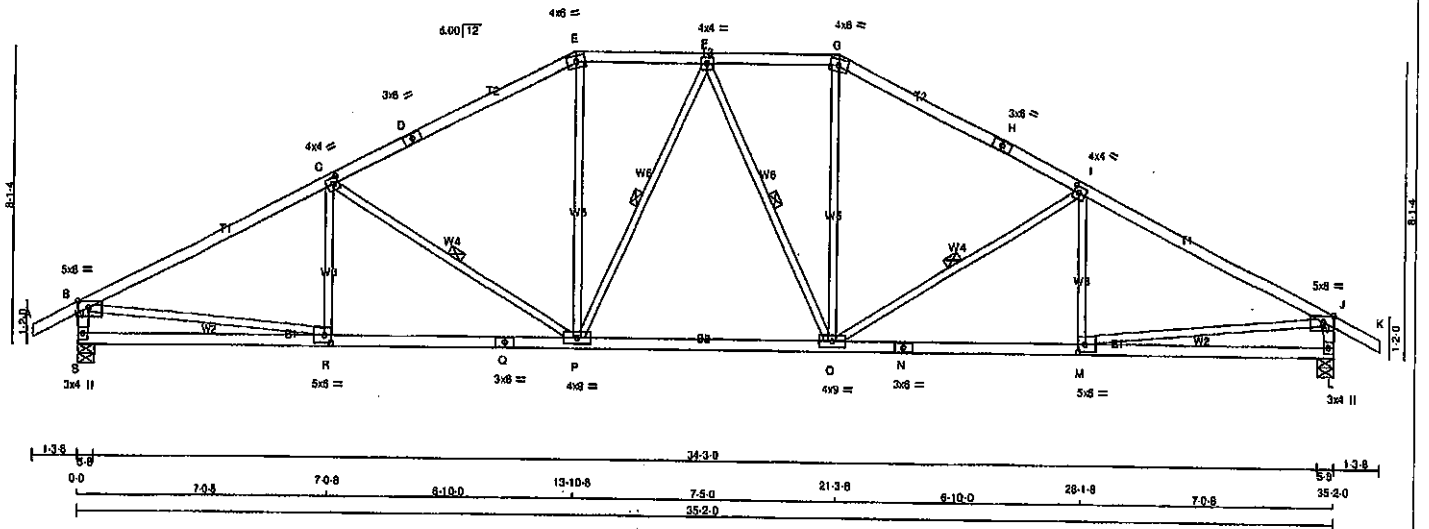

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY, SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMVW-p	MT20	5.0	8.0	Edge 3.50
C TMVW-t	MT20	4.0	4.0	2.00 1.75
D TS-t	MT20	3.0	6.0	
E TTW-m	MT20	4.0	6.0	
F TMVW-t	MT20	4.0	4.0	
G TTW-m	MT20	4.0	6.0	
H TS-t	MT20	3.0	6.0	
I TMVW-t	MT20	4.0	4.0	2.00 1.75
J TMVW-p	MT20	5.0	8.0	Edge 3.50
L BMV1-p	MT20	3.0	4.0	
M BMVW-t	MT20	5.0	8.0	2.50 2.25
N SS-t	MT20	3.0	6.0	
O BMVWW-t	MT20	4.0	9.0	
P BMVW-t	MT20	4.0	9.0	
Q SS-t	MT20	3.0	6.0	
R BMVW-t	MT20	5.0	8.0	2.50 2.25
S BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
S	2063	0	2063	0	0
L	2063	0	2063	0	0

UNFACTORED REACTIONS		1ST LCASE	MAX /MIN. COMPONENT REACTIONS	PERM LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
S	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-P, F-P, F-O, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING		TOTAL LOAD CASES: (4)									
CHORDS		MEMB.					WEBS				
MEMB.	FORCE (LBS)	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MEMB.	FORCE (LBS)	MAX. FACTORED	FACTORED	VERT. LOAD
FR-TO							FR-TO				
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	10.00	R-C	-182 / 52	0.08 (1)	0.08 (1)	0.08 (1)
B-C	-2908 / 0	-91.8	-91.8	0.83 (1)	3.25	3.25	C-P	-637 / 0	0.29 (1)	0.29 (1)	0.29 (1)
C-D	-2373 / 0	-91.8	-91.8	0.72 (1)	3.66	3.66	P-E	0 / 674	0.15 (1)	0.15 (1)	0.15 (1)
D-E	-2373 / 0	-91.8	-91.8	0.72 (1)	3.66	3.66	P-F	-222 / 0	0.11 (1)	0.11 (1)	0.11 (1)
E-F	-2100 / 0	-91.8	-91.8	0.19 (1)	4.53	4.53	F-O	-222 / 0	0.11 (1)	0.11 (1)	0.11 (1)
F-G	-2100 / 0	-91.8	-91.8	0.19 (1)	4.53	4.53	O-G	0 / 574	0.15 (1)	0.15 (1)	0.15 (1)
G-H	-2373 / 0	-91.8	-91.8	0.72 (1)	3.66	3.66	O-I	-637 / 0	0.29 (1)	0.29 (1)	0.29 (1)
H-I	-2373 / 0	-91.8	-91.8	0.72 (1)	3.66	3.66	I-J	-182 / 52	0.08 (1)	0.08 (1)	0.08 (1)
I-J	-2906 / 0	-91.8	-91.8	0.83 (1)	3.25	3.25	B-R	0 / 2649	0.60 (1)	0.60 (1)	0.60 (1)
J-K	0 / 28	-91.8	-91.8	0.12 (1)	10.00	10.00	M-J	0 / 2649	0.60 (1)	0.60 (1)	0.60 (1)
S-B	-2008 / 0	0.0	0.0	0.20 (1)	5.96	5.96					
L-J	-2008 / 0	0.0	0.0	0.20 (1)	5.96	5.96					
S-R	0 / 0	-18.5	-18.5	0.20 (4)	10.00	10.00					
R-Q	0 / 2630	-18.5	-18.5	0.52 (1)	10.00	10.00					
Q-P	0 / 2630	-18.5	-18.5	0.52 (1)	10.00	10.00					
P-O	0 / 2193	-18.5	-18.5	0.45 (1)	10.00	10.00					
O-N	0 / 2630	-18.5	-18.5	0.52 (1)	10.00	10.00					
N-M	0 / 2630	-18.5	-18.5	0.52 (1)	10.00	10.00					
M-L	0 / 0	-18.5	-18.5	0.20 (4)	10.00	10.00					

TOTAL WEIGHT = 2 X 145 = 291 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBCO 2018, CBC 2012, ABC 2019
- PART 9 OF CBCO 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CSI: TC=0.63/1.00 (B-C:1), BC=0.52/1.00 (P-R:1), WB=0.60/1.00 (B-R:1), SS=0.28/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1967 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.88 (M) (INPUT = 0.90)
JSI METAL= 0.79 (Q) (INPUT = 1.00)

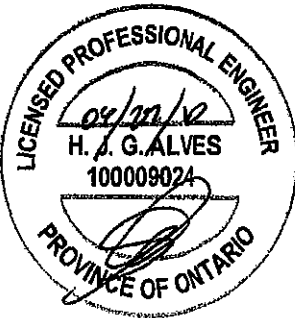

Structural component only
DWG# T-2007173

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T45	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version B.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 13:02:22 2020 Page 1
 ID:K?TPdngi0npl1q1YdbWIOFzIdG-wpi_zbGopuDKIM9AMzQsy6jVPhiyXGb2SiazNB1V
 352 0 18-58
 Scale = 1/50.0

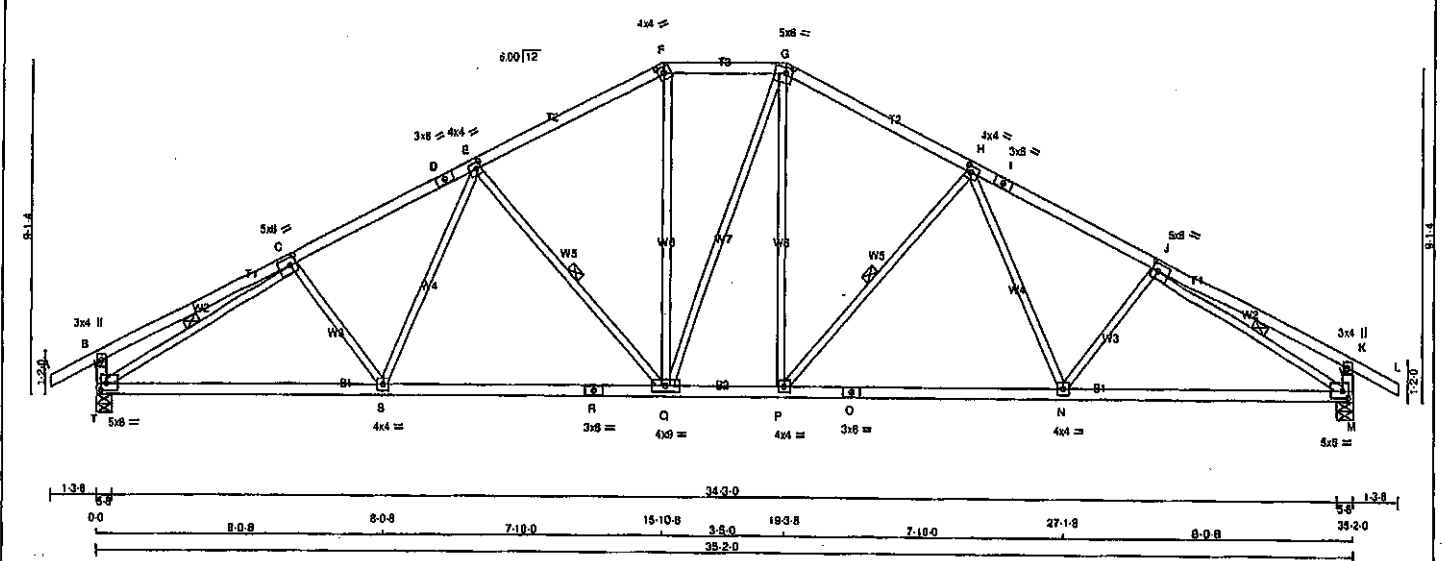

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
T - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
T - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (Table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMVW-1	MT20	5.0	6.0	2.50 2.25
D	TS-1	MT20	3.0	6.0	
E	TMVW-1	MT20	4.0	4.0	2.00 1.50
F	TTW-h	MT20	4.0	4.0	2.00 1.75
G	TTW-m	MT20	5.0	8.0	2.00 2.00
H	BMVW-1	MT20	4.0	4.0	2.00 1.50
I	TS-1	MT20	3.0	6.0	
J	TMVW-1	MT20	5.0	8.0	2.50 2.25
K	TMV+p	MT20	3.0	4.0	
M	BMVW-1	MT20	5.0	6.0	2.25 2.00
N, P, S					
N	BMVW-1	MT20	4.0	4.0	
O	BS-1	MT20	3.0	6.0	
Q	BMVW-1	MT20	4.0	4.0	
R	BS-1	MT20	3.0	6.0	
T	BMVW-1	MT20	5.0	6.0	2.25 2.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	GROSS REACTION	GROSS REACTION	GROSS REACTION	BRG	BRG	BRG	BRG
T	2083	0	2083	0	0	5-8	5-8	5-8	5-8
M	2083	0	2083	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST LC CASE		MAX / MIN COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
T	1457	989 / 0	0 / 0	0 / 0	483 / 0
M	1457	989 / 0	0 / 0	0 / 0	483 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, M

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, H-P, C-T, J-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	C-S	-110 / 37 0.04 (1)
B-C	0 / 19	-91.8	-91.8	0.32 (1)	10.00	S-E	0 / 276 0.08 (1)
C-D	-2759 / 0	-91.8	-91.8	0.40 (1)	3.88	E-Q	-881 / 0 0.31 (1)
D-E	-2759 / 0	-91.8	-91.8	0.40 (1)	3.88	Q-F	0 / 813 0.14 (1)
E-F	-2187 / 0	-91.8	-91.8	0.36 (1)	4.30	F-G	0 / 4 0.00 (1)
F-G	-1925 / 0	-91.8	-91.8	0.18 (1)	4.71	G-H	0 / 809 0.14 (1)
G-H	-2168 / 0	-91.8	-91.8	0.36 (1)	4.30	H-I	-682 / 0 0.31 (1)
H-I	-2760 / 0	-91.8	-91.8	0.40 (1)	3.88	I-N	0 / 276 0.08 (1)
I-J	-2760 / 0	-91.8	-91.8	0.40 (1)	3.88	N-J	-110 / 37 0.04 (1)
J-K	0 / 19	-91.8	-91.8	0.32 (1)	10.00	T-C	-3040 / 0 0.85 (1)
K-L	0 / 28	-91.8	-91.8	0.12 (1)	10.00	J-M	-3041 / 0 0.85 (1)
T-B	-328 / 0	0.0	0.0	0.03 (1)	7.81		
M-K	-326 / 0	0.0	0.0	0.03 (1)	7.81		
T-S	0 / 2536	-18.5	-18.5	0.56 (1)	10.00		
S-R	0 / 2362	-18.5	-18.5	0.53 (1)	10.00		
R-Q	0 / 2362	-18.5	-18.5	0.53 (1)	10.00		
Q-P	0 / 1924	-18.5	-18.5	0.40 (1)	10.00		
P-O	0 / 2362	-18.5	-18.5	0.53 (1)	10.00		
O-N	0 / 2362	-18.5	-18.5	0.53 (1)	10.00		
N-M	0 / 2537	-18.5	-18.5	0.56 (1)	10.00		

TOTAL WEIGHT = 2 X 151 = 302 lb

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 8.0 PSF
 BOT. CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBCC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-08, CSA 086-14
 - TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
 CALCULATED VERT. DEFL. (LL) = L/989 (0.15")
 ALLOWABLE DEFL. (TL) = L/360 (1.17")
 CALCULATED VERT. DEFL. (TL) = L/989 (0.32")

CSI: TC=0.40/1.00 (H-J:1), BC=0.50/1.00 (M-N:1), WB=0.85/1.00 (J-M:1), SS=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 L.S. BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1667 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (M) (INPUT = 0.80)
 JSI METAL = 0.78 (O) (INPUT = 1.00)

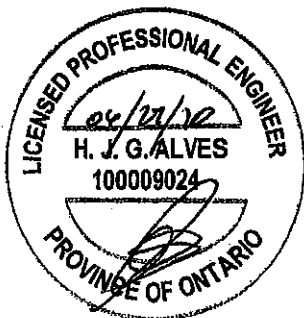


Structural component only
 DWG# T-2007174

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T46	6	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 13:02:23 2020 Page 1

ID:K?TPdhgJ0npl1qYdbWIOFzIdeG-O?HMAxHCaCLbxuLk4UIPALGz7q50ADgUfo?E1zNB1U

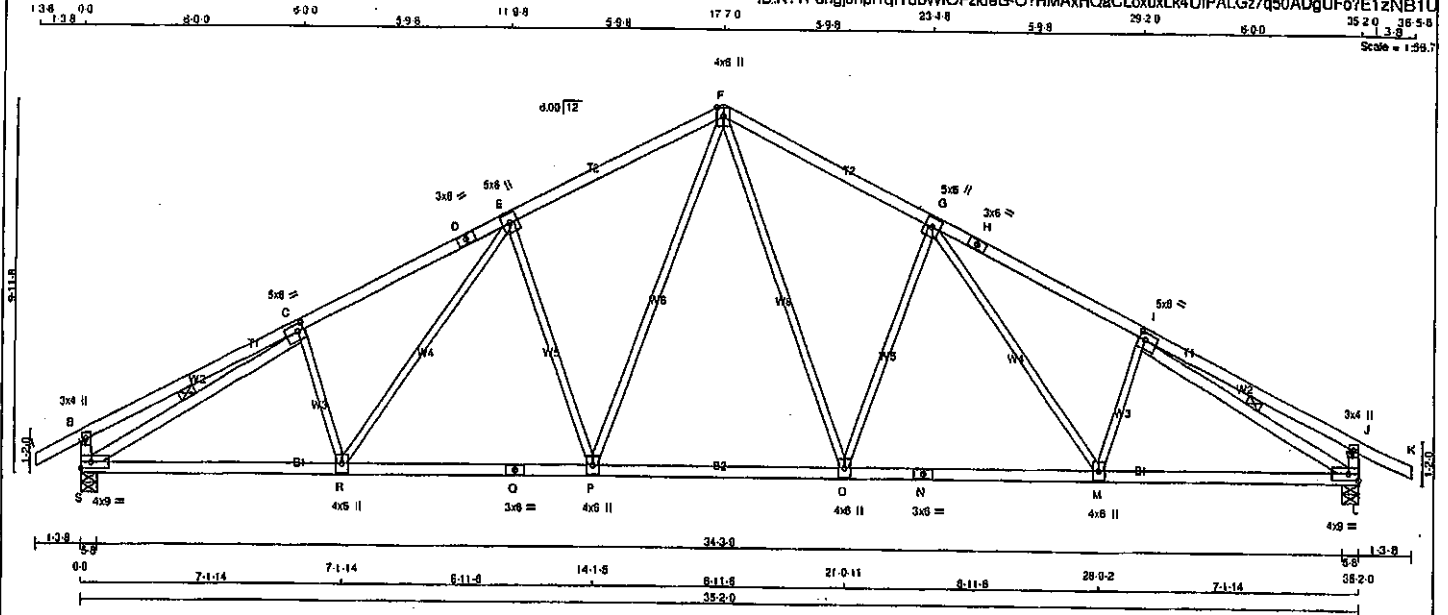

TOTAL WEIGHT = 6 X 152 = 910 lb [M/F]

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED	MAXIMUM FACTORED	INPUT	RECORD	
	GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	DOWN	HORZ	UPLIFT	IN-SX
S	2063	0	2063	0	5-8
L	2063	0	2063	0	5-8

UNFACTORED REACTIONS						
1ST LCASE	MAX/MIN	COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
S	1457	889 / 0	0 / 0	0 / 0	0 / 0	488 / 0
L	1457	889 / 0	0 / 0	0 / 0	0 / 0	488 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, I-L

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	F-O	0 / 866	0.19 (1)
B-C	0 / 22	-91.8	-91.8 0.40 (1)	10.00	C-G	-729 / 0	0.72 (1)
C-D	-2808 / 0	-91.8	-91.8 0.49 (1)	3.75	G-M	0 / 391	0.09 (1)
D-E	-2808 / 0	-91.8	-91.8 0.49 (1)	3.75	M-I	-192 / 18	0.05 (1)
E-F	-2322 / 0	-91.8	-91.8 0.48 (1)	4.07	P-F	0 / 896	0.19 (1)
F-G	-2322 / 0	-91.8	-91.8 0.46 (1)	4.07	E-P	-726 / 0	0.72 (1)
G-H	-2808 / 0	-91.8	-91.8 0.49 (1)	3.75	R-E	0 / 391	0.09 (1)
H-I	-2808 / 0	-91.8	-91.8 0.49 (1)	3.75	C-R	-192 / 18	0.05 (1)
I-J	0 / 22	-91.8	-91.8 0.40 (1)	10.00	S-C	-3004 / 0	0.72 (1)
J-K	0 / 28	-91.8	-91.8 0.12 (1)	10.00	I-L	-3664 / 0	0.72 (1)
S-B	-344 / 0	0.0	0.0 0.03 (1)	7.81			
L-J	-344 / 0	0.0	0.0 0.03 (1)	7.81			
S-R	0 / 2574	-18.5	-18.5 0.53 (1)	10.00			
R-Q	0 / 2291	-18.5	-18.5 0.47 (1)	10.00			
Q-P	0 / 2291	-18.5	-18.5 0.47 (1)	10.00			
P-O	0 / 1762	-18.6	-18.6 0.39 (1)	10.00			
O-N	0 / 2291	-18.5	-18.5 0.47 (1)	10.00			
N-M	0 / 2291	-18.5	-18.5 0.47 (1)	10.00			
M-L	0 / 2574	-18.5	-18.5 0.53 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (1.17")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.14")
ALLOWABLE DEFL.(TL) = 1/360 (1.17")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.28")

CSI: TO=0.48/1.00 (G-I), BC=0.53/1.00 (R-S), WB=0.72/1.00 (E-P), SS=0.22/1.00 (B-C)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.87 (C) (INPUT = 0.80)
JSI METAL= 0.77 (I) (INPUT = 1.00)



Structural component only
DWG# T-2007175

JOB NAME 408170	TRUSS NAME T47	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.316 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 13:02:24 2020 Page 1		ID:K?TPdhgDnpl1qIYdbWIOFzIdeG-sCrkNH2LVTSZ2WXIn?uxNuSFX80iOpjvXZmTzNB1T	

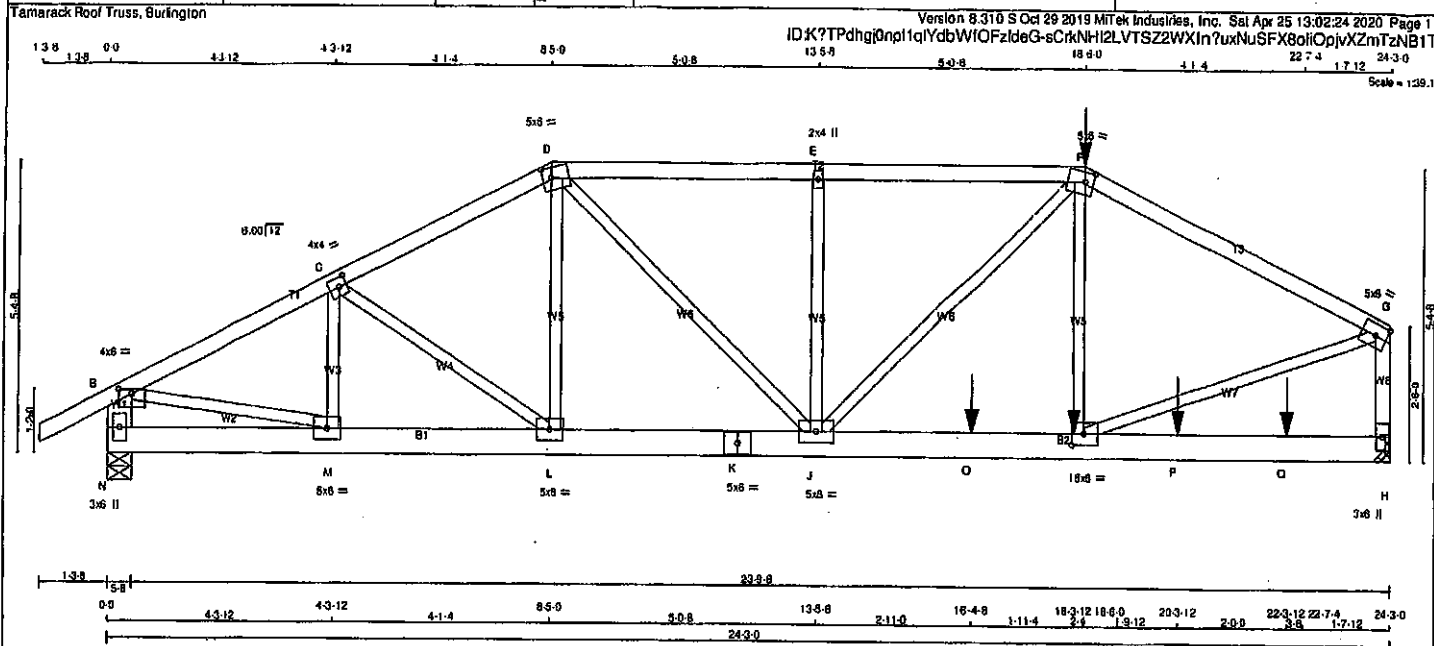

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
N - B	2x6	DRY	No.2
H - G	2x4	DRY	No.2
N - K	2x6	DRY	No.2
K - H	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - D	12	TOP
D - F	12	SIDE(61.0)
F - G	12	SIDE(61.0)
H - G	12	TOP
N - B	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
N - K	12	TOP
K - H	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	HORZ	UPLIFT
N 2120	0	2120	0
H 3119	0	3119	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 4'-0".

UNFACTORED REACTIONS			
1ST LCASE	MAX. MIN. COMPONENT REACTIONS		
JT COMBINED	SNOW	LIVE	PERM. LIVE
N 1495	1003/0	0/0	0/0
H 2201	1472/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.64 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO			
A-B	0/26	-91.8	-91.8 0.07 (1)
B-C	-2914/0	-91.8	-91.8 0.17 (1)
C-D	-2892/0	-91.8	-91.8 0.17 (1)
D-E	-3517/0	-91.8	-91.8 0.27 (1)
E-F	-3517/0	-91.8	-91.8 0.27 (1)
F-G	-3466/0	-91.8	-91.8 0.39 (1)
N-B	-2084/0	0.0	0.0 0.07 (1)
H-G	-2933/0	0.0	0.0 0.20 (1)
N-M	0/0	-18.5	-18.5 0.03 (1)
M-L	0/2622	-18.5	-18.5 0.21 (1)
L-K	0/2568	-18.5	-18.5 0.33 (1)
K-J	0/2568	-18.5	-18.5 0.33 (1)
J-O	0/3109	-18.5	-18.5 0.69 (1)
O-I	0/3109	-18.5	-18.5 0.69 (1)
I-P	0/0	-18.5	-18.5 0.32 (1)
P-Q	0/0	-18.5	-18.5 0.32 (1)
Q-H	0/0	-18.5	-18.5 0.32 (1)

FACTORED CONCENTRATED LOADS (LBS)			
JT	LOC.	LC1	MAX. MAX.
F	18-6-0	-178	-178
I	18-3-12	-35	-35
O	18-4-8	-1681	-1681
P	20-3-12	-283	-283
Q	22-3-12	-284	-284

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.81")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.15")

CSI: TC=0.39/1.00 (F-G:1), BC=0.69/1.00 (I-J:1), WB=0.41/1.00 (G-I:1), SS=0.37/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL. IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (I) (INPUT = 0.90)
JSI METAL = 0.44 (G) (INPUT = 1.00)



Structural component only
DWG# T-2007176 42

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T47	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 13:02:24 2020 Page 2

ID:K?TPdHg0npl1q1YdWOFzIdeG-sCkNH2LVTSZ2WXIn?uxNuSFX8oliOpivXZmTzNB1T

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	6.0	1.00	3.00
C	TMVW-t	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	6.0	2.25	2.00
E	TMVW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.25	2.00
G	TMVW-t	MT20	5.0	6.0		Edge
H	BMV1-p	MT20	3.0	6.0		
I	BMVW-t	MT20	5.0	6.0	2.50	2.75
J	BMVW-t	MT20	5.0	6.0		
K	BS-t	MT20	5.0	6.0		
L	BMVW-t	MT20	5.0	6.0		
M	BMVW-t	MT20	5.0	6.0		
N	BMV1-p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2007176 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T48	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 13:02:26 2020 Page 1
ID:K7TPdhgJnpl1qIYdbWIOFzIdaG-LOP7bdJg6pbJ8C5krUX7UbRc0xZ9U3GzyZH8vzNB1S

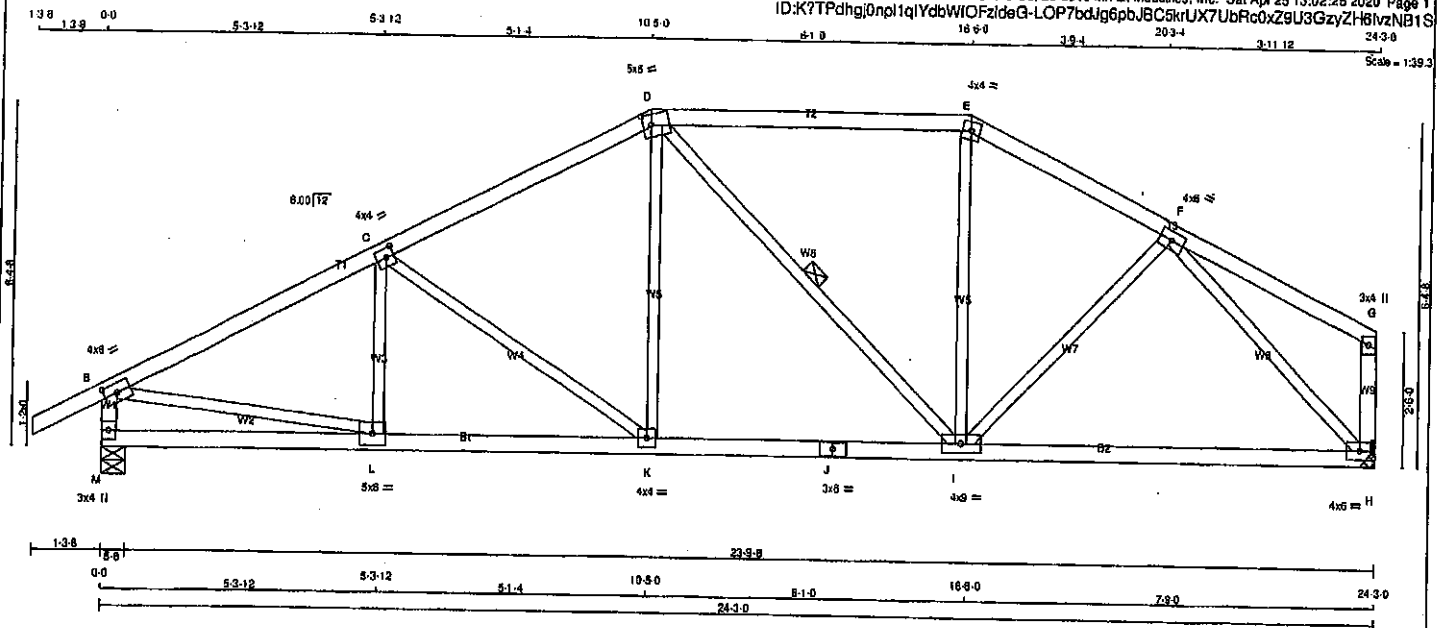

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
M - B	2x4	DRY	No.2
H - G	2x4	DRY	No.2
M - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

ORY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-1	MT20	4.0	6.0	2.00	3.00
C	TMWV-1	MT20	4.0	4.0	2.00	1.75
D	TTWV-m	MT20	5.0	6.0	2.25	2.00
E	TMWV-1	MT20	4.0	4.0		
F	TMWV-1	MT20	4.0	6.0		
G	TMWV-1	MT20	3.0	4.0		
H	BMWV-1	MT20	4.0	6.0		
I	BMWV-1	MT20	4.0	9.0		
J	BS-1	MT20	3.0	6.0		
K	BMWV-1	MT20	4.0	4.0		
L	BMWV-1	MT20	5.0	6.0		
M	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG	
M	1461 0	1461 0	0	5-8	IN-SX
H	1337 0	1337 0	0	5-8	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	1031	690 / 0	0 / 0	0 / 0	0 / 0	341 / 0	0 / 0
H	945	620 / 0	0 / 0	0 / 0	0 / 0	325 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-I.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED DOWN (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED DOWN (LBS)	MAX. FACTORED UP (LBS)
FR-TO				FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	L-C	-185 / 32	0.04 (1)
B-C	-1844 / 0	-91.8	-91.8 0.36 (1)	4.58	C-K	-438 / 0	0.31 (1)
C-D	-1488 / 0	-91.8	-91.8 0.34 (1)	5.00	K-D	0 / 334	0.08 (1)
D-E	-1181 / 0	-91.8	-91.8 0.46 (1)	5.27	D-I	-189 / 0	0.09 (1)
E-F	-1338 / 0	-91.8	-91.8 0.18 (1)	5.42	I-E	0 / 175	0.05 (4)
F-G	0 / 18	-91.8	-91.8 0.21 (1)	10.00	I-F	0 / 158	0.04 (4)
M-B	-1419 / 0	0.0	0.0 0.14 (1)	8.85	B-L	0 / 1892	0.38 (1)
H-G	-138 / 0	0.0	0.0 0.02 (1)	7.81	F-H	-1563 / 0	0.82 (1)
M-L	0 / 0	-18.5	-18.5 0.12 (4)	10.00			
L-K	0 / 1871	-18.5	-18.5 0.32 (1)	10.00			
K-J	0 / 1313	-18.5	-18.5 0.36 (4)	10.00			
J-I	0 / 1313	-18.5	-18.5 0.38 (4)	10.00			
I-H	0 / 1089	-18.5	-18.5 0.34 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TFC 2011, TFC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.81")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.48/1.00 (D-E:1), BC=0.38/1.00 (I-K:4), WB=0.82/1.00 (F-H:1), SS=0.22/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354
	1667	788
	1987	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (8) (INPUT = 0.90)
JSI METAL= 0.50 (8) (INPUT = 1.00)



Structural component only
DWG# T-2007177


Scale = 1:25.1

Structural component only
DWG# T-2007178

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T50	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 9 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:28 2020 Page 1
ID:K7TPdhg0npl1qYdbWIOFzdeG-lz5FDILZPkzu2gpJXd4q6D3AB6cJhXEPeXWmvEzNB1P

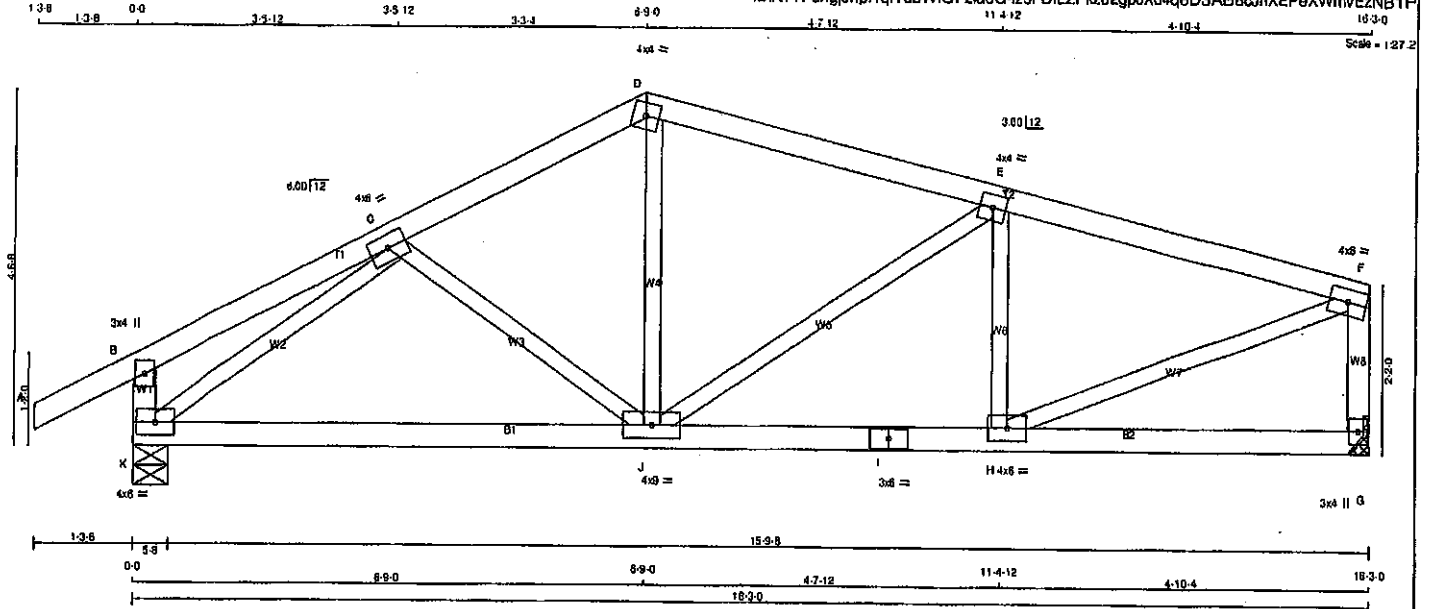

TOTAL WEIGHT = 2 X 63 = 126 lb (M/F)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
K - B	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
I - G	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
B TMV+p MT20	3.0	4.0		
C TMWW-1 MT20	4.0	8.0		
D TTW+ MT20	4.0	4.0		
E TMWW-1 MT20	4.0	4.0		
F TMWW-1 MT20	4.0	8.0		
G BMV+p MT20	3.0	4.0		
H BMWW-1 MT20	4.0	8.0		
I BS+ MT20	3.0	6.0		
J BMWW-1 MT20	4.0	9.0		
K BMWW-1 MT20	4.0	8.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UP/FT	IN-SX
K	1020	0	1020	0
G	896	0	896	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS	1ST LOASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
K	719	485 / 0
G	633	416 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.73 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING	CHORDS	WEBS
	MAX. FACTORED	MAX. FACTORED
	MEMB. FORCE (LBS)	MEMB. FORCE (LBS)
	VERT. LOAD LC1	MAX. FACTORED
	FROM TO	CS1 (LC)
FR-TO	FROM TO	LENGTH FR-TO
A-B	0 / 28	10.00
B-C	0 / 14	10.00
C-D	-862 / 0	8.20
D-E	-894 / 0	8.18
E-F	-1094 / 0	5.73
K-B	-248 / 0	7.81
G-F	-855 / 0	7.81
K-J	0 / 956	10.00
J-I	0 / 1073	10.00
I-H	0 / 1073	10.00
H-G	0 / 0	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.54")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.03")
ALLOWABLE DEFL. (TL) = $L/360$ (0.54")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.03")

CS1 TO=0.27/1.00 (E-F:1), BC=0.27/1.00 (H-J:1),
WB=0.35/1.00 (C-K:1), SS=0.21/1.00 (E-F:1)

OOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.71 (H) (INPUT = 0.90)
JSI METAL= 0.32 (I) (INPUT = 1.00)




Structural component only
DWG# T-2007179

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T51	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:29 2020 Page 1
ID:K7TPdhgIOnpl1qYdbWOFzIdeG-D9fdR7MBA25fpOV4Kb3aRbKcYx2QzGZIBFKSgzNB1C

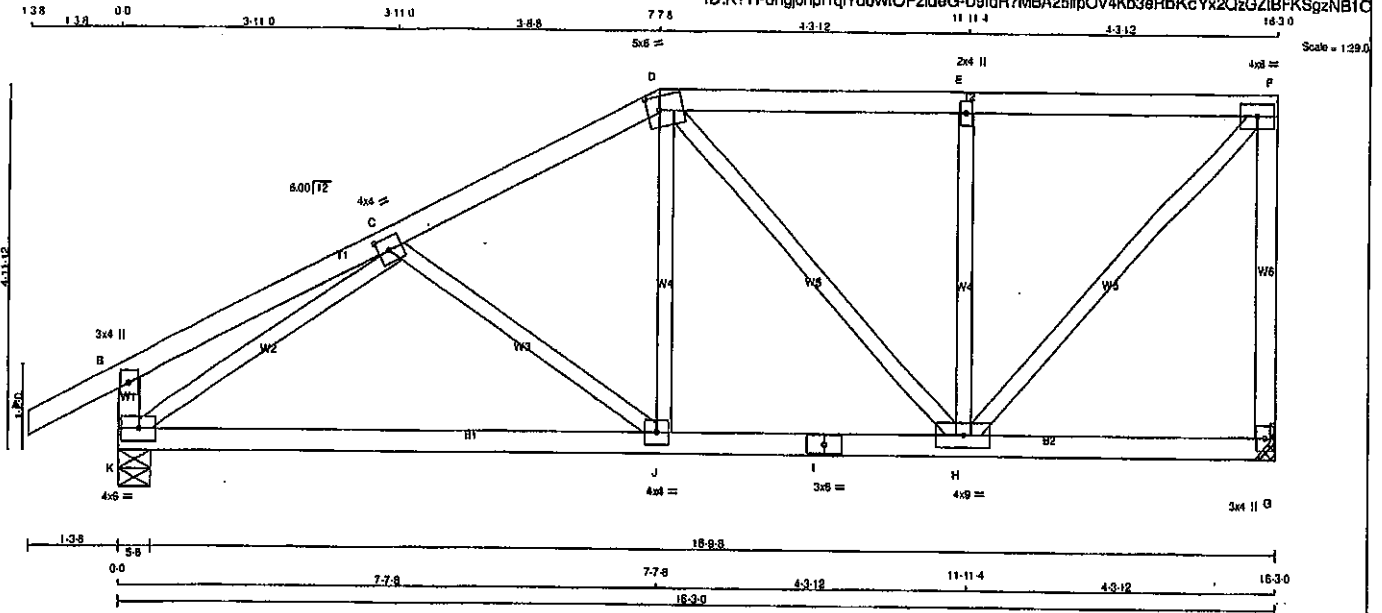

TOTAL WEIGHT = 70 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
G - F	2x4	DRY	No.2
K - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0		
C	TMVW-1	MT20	4.0	4.0	2.00	1.75
D	TTWV-m	MT20	5.0	8.0	2.25	2.00
E	TMVW-w	MT20	2.0	4.0		
F	TMVW-1	MT20	4.0	8.0		
G	BMV-1-p	MT20	3.0	4.0		
H	BMVWVW-1	MT20	4.0	9.0		
I	BS-1	MT20	3.0	6.0		
J	BMVWVW-1	MT20	4.0	4.0		
K	BMVWVW-1	MT20	4.0	8.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	DOWN	HORIZ	DOWN	HORIZ	UP/LIFT	IN-SX	BRG	IN-SX
G	898	0	0	898	0	0	0	MECHANICAL	0
K	1020	0	0	1020	0	0	5-8	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
G	833	416 / 0	0 / 0	0 / 0	0 / 0	218 / 0	0 / 0
K	719	485 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.21 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	C-J	-215 / 0 0.08 (1)	
B-C	0 / 17	-91.8	-91.8 0.20 (1)	10.00	J-D	0 / 286 0.06 (1)	
C-D	-901 / 0	-91.8	-91.8 0.22 (1)	6.21	D-H	-210 / 0 0.14 (1)	
D-E	-654 / 0	-91.8	-91.8 0.29 (1)	6.25	H-E	-488 / 0 0.18 (1)	
E-F	-654 / 0	-91.8	-91.8 0.29 (1)	6.25	H-F	0 / 981 0.22 (1)	
F-G	-658 / 0	0.0	0.0 0.35 (1)	7.81	K-C	-1192 / 0 0.43 (1)	
K-B	-261 / 0	0.0	0.0 0.03 (1)	7.81			
K-J	0 / 985	-18.5	-18.5 0.30 (4)	10.00			
J-I	0 / 798	-18.5	-18.5 0.30 (4)	10.00			
I-H	0 / 796	-18.5	-18.5 0.30 (4)	10.00			
H-G	0 / 0	-18.5	-18.5 0.08 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	OL = 8.0	PSF
BOT CH.	LL = 9.0	PSF
	OL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.54")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.02")
ALLOWABLE DEFL.(TL) = $L/360$ (0.54")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.12")

CSI: TC=0.35/1.00 (F-G:1), BC=0.30/1.00 (J-K:4),
WB=0.43/1.00 (C-K:1), SSI=0.19/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	(PL)
MAX	MIN	MAX	MIN
MT20	618	354	1667
	788	1987	1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.86 (C) (INPUT = 0.90)
JSI METAL= 0.40 (C) (INPUT = 1.00)

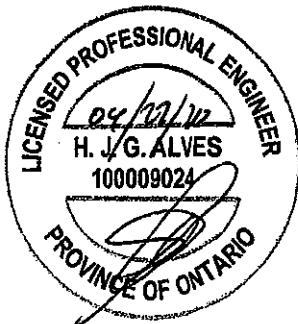

Structural component only
DWG# T-2007180

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	G52	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:13 2020 Page 1
ID:K?TPdhgJ0npl1qYdbWOFzideG-h4na4W99x740IMAO9zJ73xI05YfgpiGBiNUtzcNB1e

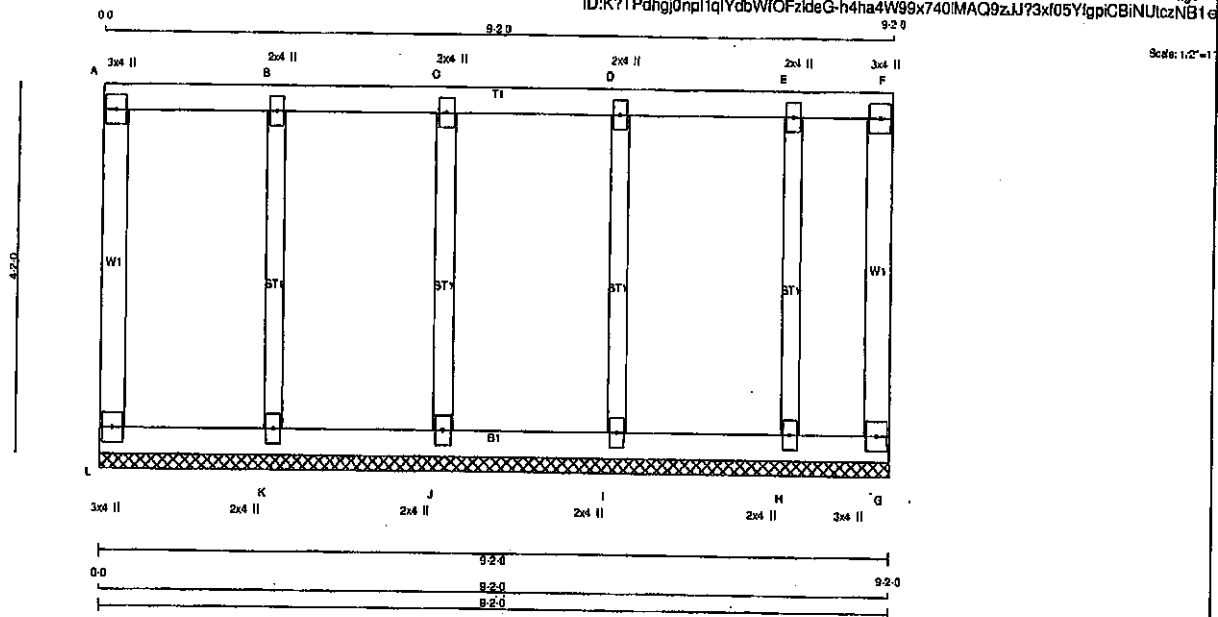

TOTAL WEIGHT = 41 lb (M/R)

LUMBER				
N. L. G. A. RULES	SIZE	LUMBER	DESCR.	
CHORDS				
L - A	2x4 DRY	No.2	SPF	
A - F	2x4 DRY	No.2	SPF	
G - F	2x4 DRY	No.2	SPF	
L - G	2x4 DRY	No.2	SPF	
ALL WEBS	2x3 DRY	No.2	SPF	
ALL GABLE WEBS	2x3 DRY	No.2	SPF	
DRY: SEASONED LUMBER.				
GABLE STUDS SPACED AT 2-0-0 OC.				

PLATES (tablets in inches)				
JT TYPE	PLATES	W	LEN	Y X
A TMV+p	MT20	3.0	4.0	
B, C, D, E				
B TMV+w	MT20	2.0	4.0	
F TMV+p	MT20	3.0	4.0	
G BMV1+p	MT20	3.0	4.0	
H, I, J, K				
H BMV1+w	MT20	2.0	4.0	
L BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER
PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING.
BEARINGS
 THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
 THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)
BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	LC1 MAX	MAX. UNBRACED LENGTH (FT)
FR-TO		FROM TO			FR-TO				
L-A	-100 / 0	0.0 0.0	0.02 (1)	7.81	K-B	-245 / 0	0.09 (1)	0.08 (1)	10.00
A-B	-4 / 0	-114.3 -114.3	0.08 (1)	10.00	J-C	-224 / 0	0.08 (1)	0.08 (1)	10.00
B-C	-4 / 0	-114.3 -114.3	0.08 (1)	10.00	I-D	-238 / 0	0.08 (1)	0.08 (1)	10.00
C-D	-4 / 0	-114.3 -114.3	0.07 (1)	10.00	H-E	-188 / 0	0.08 (1)	0.08 (1)	10.00
D-E	-4 / 0	-114.3 -114.3	0.07 (1)	10.00					
E-F	-4 / 0	-114.3 -114.3	0.05 (1)	10.00					
G-F	-54 / 0	0.0 0.0	0.02 (1)	7.81					
L-K	0 / 4	-18.5 -18.5	0.02 (4)	10.00					
K-J	0 / 4	-18.5 -18.5	0.02 (4)	10.00					
J-I	0 / 4	-18.5 -18.5	0.02 (4)	10.00					
I-H	0 / 4	-18.5 -18.5	0.02 (4)	10.00					
H-G	0 / 4	-18.5 -18.5	0.01 (4)	10.00					

DESIGN CRITERIA
 SPECIFIED LOADS:
 TOP CH. LL = 25.8 PSF
 DL = 15.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 48.0 PSF
SPACING = 24.0 IN. C/C
 LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12
 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015
 THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014
 (55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.8 P.S.F. SPECIFIED ROOF LIVE LOAD
 CSI: TC=0.08/1.00 (B-C:1), BC=0.02/1.00 (J-K:4), WB=0.09/1.00 (B-K:1), SS=0.13/1.00 (A-B:1)
 DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10
 COMPANION LIVE LOAD FACTOR = 1.00
 FLAT ROOF FACTOR = 0.75
 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
 NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
 MAX MIN MAX MIN MAX MIN
 MT20 816 354 1687 788 1987 1658
 PLATE PLACEMENT TOL. = 0.250 inches
 PLATE ROTATION TOL. = 5.0 Deg.
 JSI GRIP = 0.17 (B) (INPUT = 0.90)
 JSI METAL = 0.07 (K) (INPUT = 1.00)




Structural component only
DWG# T-2007166

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T53S	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 \$ Oct 29 2019 Mitex Industries, Inc. Sat Apr 25 13:02:30 2020 Page 1
ID:K?TPdHgJ0nph1qYobWIOFzIdG-hLC0eLnpxLDcHzzhe26IBe8YnyLF9WNi5r?L_7zNB1N

Scale = 1/26.0

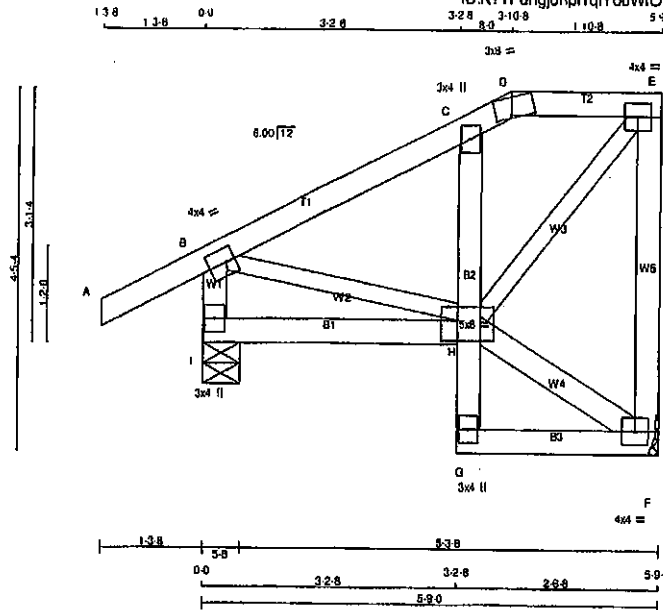

TOTAL WEIGHT = 33 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
I - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
G - C	2x4	DRY	No.2
G - F	2x4	DRY	No.2
ALL WEBS	2x4	DRY	No.2
EXCEPT			
B - H	2x3	DRY	No.2
H - E	2x3	DRY	No.2

DRY; SEASONED LUMBER.

PLATES (table in inches)			
JT TYPE	PLATES	W	LEN Y X
B	TMVW-1	MT20	4.0 4.0 2.00 1.25
C	TMV-p	MT20	3.0 4.0
D	TT-m	MT20	3.0 6.0 0.50 2.50
E	TMVW-1	MT20	4.0 4.0
F	BMVW-1	MT20	4.0 4.0
G	BMV-p	MT20	3.0 4.0
H	BMVWW-1	MT20	5.0 8.0 3.00 2.50
I	BMV1-p	MT20	3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT HORZ	DOWN HORZ UPLIFT	IN-SX	IN-SX
F 302 0	302 0 0	MECHANICAL	
I 457 0	457 0 0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN COMPONENT REACTIONS					
JT COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F 214	138 / 0	0 / 0	0 / 0	0 / 0	75 / 0	0 / 0
I 320	225 / 0	0 / 0	0 / 0	0 / 0	95 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. MAX. UNBRAC LENGTH (LC)
FR-TO			
A-B	0 / 28	-91.8 -91.8	0.12 (1) 10.00
B-C	-217 / 0	-91.8 -91.8	0.14 (1) 6.25
C-D	-200 / 0	-91.8 -91.8	0.05 (1) 6.25
D-E	-167 / 0	-91.8 -91.8	0.03 (1) 6.25
E-F	-273 / 0	0.0 0.0	0.03 (1) 7.81
F-B	-420 / 0	0.0 0.0	0.04 (4) 7.81
I-H	0 / 41	-18.5 -18.5	0.05 (4) 10.00
G-H	0 / 25	0.0 0.0	0.02 (1) 10.00
H-C	-188 / 0	0.0 0.0	0.04 (1) 7.81
G-F	0 / 16	-18.5 -18.5	0.02 (4) 10.00

WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRAC LENGTH (LC)	FR-TO
H-F	-10 / 0	0.00 (1)	
B-H	0 / 153	0.03 (1)	
H-E	0 / 247	0.08 (1)	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = 1 / 999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = 1 / 999 (0.00")

CSI: TC=0.14/1.00 (B-C:1), BC=0.05/1.00 (H-I:4), WB=0.08/1.00 (E-H:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.36 (H) (INPUT = 0.80)
JSI METAL = 0.13 (B) (INPUT = 1.00)

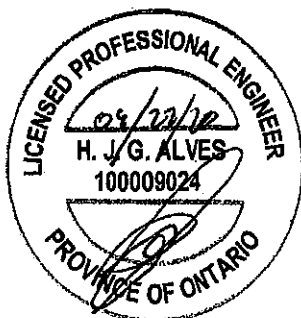


Structural component only
DWG# T-2007181

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T54S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Sat Apr 25 13:02:31 2020 Page 1
ID:K2TPdngi0npl1qYdbWIOFzideG-9YmOrgNRhILTV7YICleXkshknMhnguyRiKVKRWZzNB1M

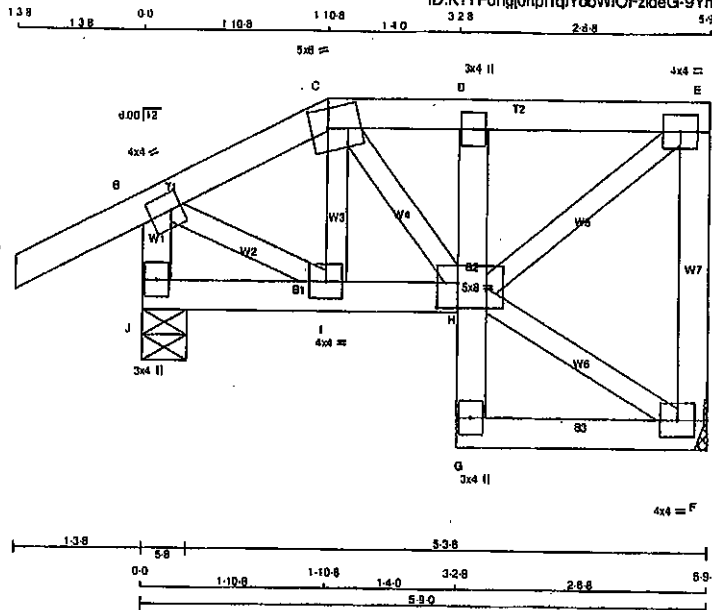

Scale = 1/2" = 1'-0"

TOTAL WEIGHT = 31 lb

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
J - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
G - D	2x4	DRY	No.2
G - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	4.0	2.00	1.25
C	TTWW-m	MT20	5.0	8.0	2.25	2.00
D	TMVW-1	MT20	3.0	4.0		
E	TMVW-1	MT20	4.0	4.0		
F	BMVW-1	MT20	4.0	4.0		
G	BMVW-1	MT20	3.0	4.0		
H	BMVWW-1	MT20	5.0	8.0	3.00	2.50
I	BMVW-1	MT20	4.0	4.0		
J	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	302	0	302	0
J	456	0	456	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	214	138 / 0	0 / 0	0 / 0	0 / 0	75 / 0	0 / 0
J	320	225 / 0	0 / 0	0 / 0	0 / 0	95 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. FACTORED VERT. LOAD (LC1)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. FACTORED VERT. LOAD (LC1)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 28	-91.8	-91.8	10.00	F-C	-50 / 10	0.01 (1)
B-C	-240 / 0	-91.8	-91.8	8.25	C-H	0 / 84	0.02 (1)
C-D	-246 / 0	-91.8	-91.8	8.25	H-F	-9 / 0	0.00 (1)
D-E	-241 / 0	-91.8	-91.8	8.25	H-E	0 / 302	0.07 (1)
F-E	-276 / 0	0.0	0.0	7.81	B-I	0 / 214	0.05 (1)
J-B	-439 / 0	0.0	0.0	0.04 (1)			
J-I	0 / 0	-18.5	-18.5	0.02 (4)			
I-H	0 / 193	-18.5	-18.5	0.04 (1)			
G-H	0 / 25	0.0	0.0	0.02 (1)			
H-D	-219 / 0	0.0	0.0	0.01 (1)			
G-F	0 / 8	-18.5	-18.5	0.03 (4)			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(85 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (H-I:1), WB=0.07/1.00 (E-H:1), SI=0.10/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

MAX. VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.33 (B) (INPUT = 0.90)
JSI METAL = 0.13 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007182

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T55	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 13:02:32 2020 Page 1
ID:K7TPdhqj0npl1qlYdbWIOFzdeG-dkKm30C3SztJWH74mT9mG3DvHI_9dNX?Z9U_27zNB1L

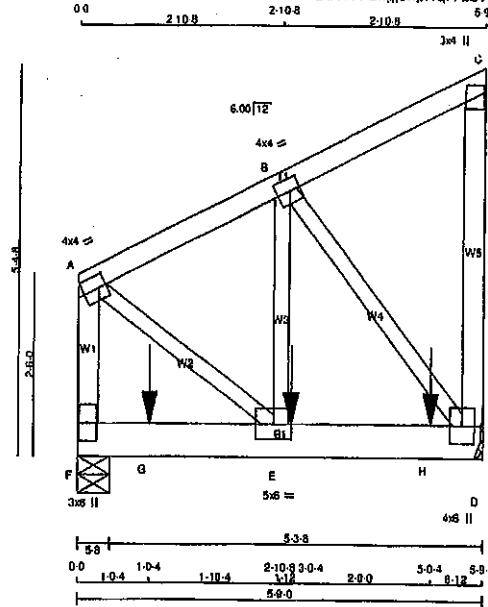

Scale = 1:29.2

TOTAL WEIGHT = 2 X 34 = 67 lb (M)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - A	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	
F - D	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F - A	12	TOP
A - C	12	TOP
C - D	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D	12	SIDE (183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
B - E	6	SIDE (45.8)
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	4.0	4.0	2.00	1.25
B	TMVW-1	MT20	4.0	4.0	2.00	1.75
C	TMV+p	MT20	3.0	4.0		
D	BMVW1+p	MT20	4.0	8.0		
E	BMVW-1	MT20	5.0	8.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT VERT	DOWN	UP	IN-SX	IN-SX
F	1589	0	0	5-8
D	1680	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	1121	750 / 0	0 / 0	0 / 0	0 / 0	371 / 0	0 / 0
D	1185	782 / 0	0 / 0	0 / 0	0 / 0	394 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MAX. FACTORED		FACTORED		MAX. FACTORED				
MEMB.	FORCE	VERT. LOAD	LC1	MAX.	MEMB.	FORCE	MAX	
(LBS)	(LBS)	(PLF)	(LC)	UNBRAC	(LBS)	(LBS)	(LC)	
FR-TO		FROM	TO	LENGTH	FR-TO			
F-A	-1074 / 0	0.0	0.0	0.07 (1)	7.61	A-E	0 / 975	0.12 (1)
A-B	-867 / 0	-91.8	-91.8	0.08 (1)	6.25	E-B	0 / 1044	0.13 (1)
B-C	-12 / 0	-91.8	-91.8	0.06 (1)	8.25	B-D	-1248 / 0	0.21 (1)
D-C	-105 / 0	0.0	0.0	0.02 (1)	7.61			
F-G	0 / 0	-18.5	-18.5	0.19 (1)	10.00			
G-E	0 / 0	-18.5	-18.5	0.19 (1)	10.00			
E-H	0 / 786	-18.5	-18.5	0.21 (1)	10.00			
H-D	0 / 786	-18.5	-18.5	0.21 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
E	3-0-4	-877	-877	---	BACK	VERT	TOTAL	---	C1
G	1-0-4	-877	-877	---	BACK	VERT	TOTAL	---	C1
H	5-0-4	-880	-880	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
OL = 8.0 PSF
BOT CH. LL = 0.0 PSF
OL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2010
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/989 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/989 (0.01")

CSI: TC=0.07/1.00 (A-F:1), BC=0.21/1.00 (D-E:1), WB=0.21/1.00 (B-D:1), SSI=0.20/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1887	788	1937	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.72 (A) (INPUT = 0.90)
JSI METAL = 0.16 (D) (INPUT = 1.00)



Structural component only
DWG# T-2007183/1/2

CONTINUED ON PAGE 2


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T55	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:22 2020 Page 2
ID:K?TPdhaiDnpl1alYdbWIOFzldG-dkkm30Q3SzTJWH74mT9mG3DvHI 9dNX7Z9U 27zNB1L


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
F	BMV1+φ	MT20	3.0	6.0		

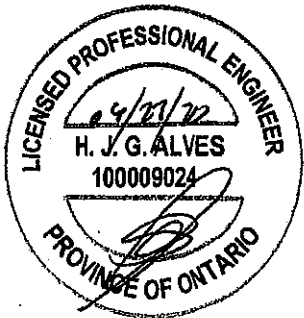

Structural component only
DWG# T-2007183

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ORWG NO.
408170	T56	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

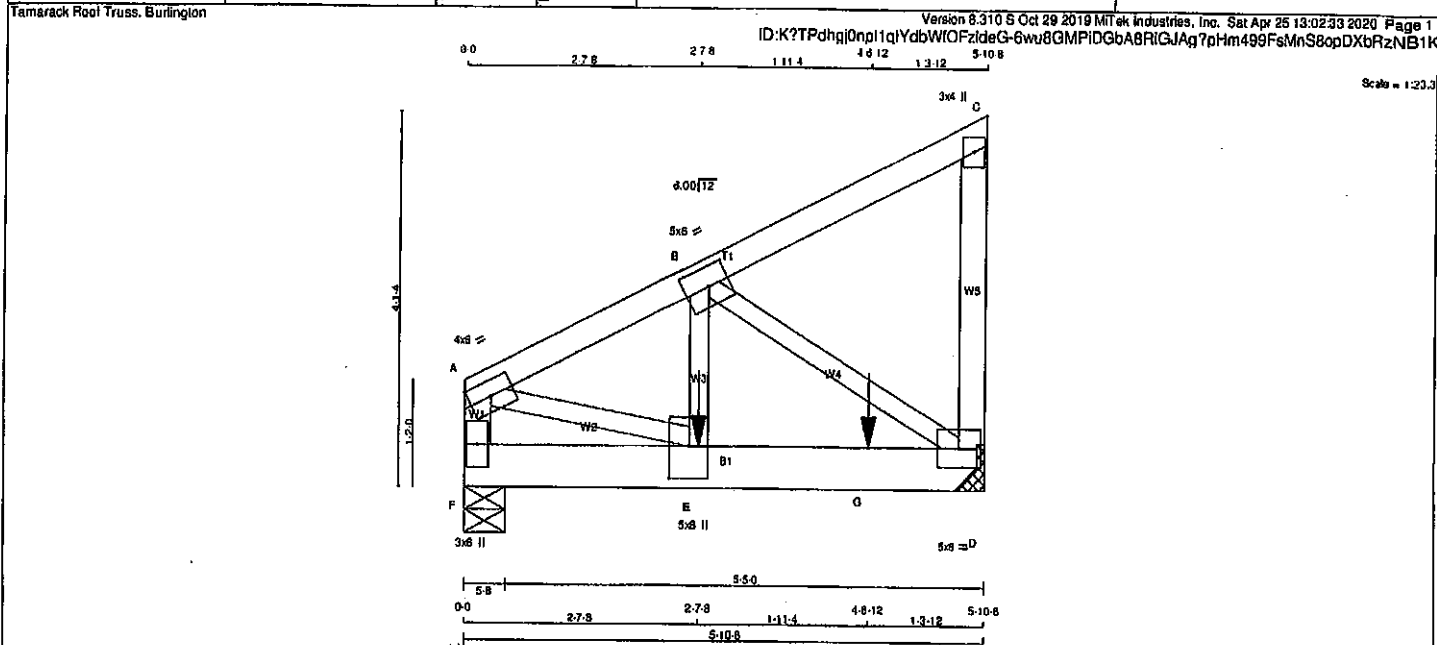

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - A	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
F - D	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS	ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS			
F-A	1	12	TOP
A-C	1	12	TOP
C-D	1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS			
F-D	2	5	SIDE(549.3)
WEBS : (0.122"x3") SPIRAL NAILS			
B-E	1	2	SIDE(259.5)
2x3	1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMW-1	MT20	4.0	8.0		Edge
B	TMW-1	MT20	5.0	6.0	2.60	2.75
C	TMW-9	MT20	3.0	4.0		
D	BMW-1	MT20	5.0	8.0		
E	BMW-1	MT20	5.0	8.0	4.25	2.50

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT HORZ	DOWN HORZ UPLIFT	IN-SX	IN-SX
F 2334 0	2334 0	5-8	5-8
D 2733 0	2733 0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4'-0".

UNFACTORED REACTIONS							
1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	1846	1103 / 0	0 / 0	0 / 0	0 / 0	543 / 0	0 / 0
D	1929	1290 / 0	0 / 0	0 / 0	0 / 0	639 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	FACTORED CS1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO					FR-TO		
F-A	-2316 / 0	0.0	0.0 0.13 (1)	7.37	A-E	0 / 2898	0.38 (1)
A-B	-3101 / 0	-91.8	-91.8 0.08 (1)	5.20	E-B	0 / 2898	0.36 (1)
B-C	-5 / 0	-91.8	-91.8 0.08 (1)	10.00	B-D	-3303 / 0	0.42 (1)
D-C	-138 / 0	0.0	0.0 0.02 (1)	7.81			
F-E	0 / 0	-18.5	-18.5 0.01 (4)	10.00			
E-G	0 / 2779	-18.5	-18.5 0.57 (1)	10.00			
G-D	0 / 2779	-18.5	-18.5 0.57 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	2-7-8	-3101	-3101	---	BACK	VERT	TOTAL	---	C1
G	4-8-12	-1318	-1318	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 29 = 57 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.20")
CALCULATED VERT. DEFL.(LL) = L/989 (0.02")
ALLOWABLE DEFL.(TL) = L/380 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CS1: TO=0.13/1.00 (A-F:1), BC=0.57/1.00 (D-E:1), WB=0.42/1.00 (B-D:1), SS1=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1857
	768	1987	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (E) (INPUT = 0.90)
JSI METAL= 0.60 (E) (INPUT = 1.00)




Structural component only
DWG# T-2007184 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T56	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 28 2019 Mitek Industries, Inc. Sat Apr 25 13:02:33 2020 Page 2
ID:K?TPdhq0npl1qYdbWIOFzIdeG-6wu8GMPiDGBA8RIGJAq?oHm499FmMnS8opDXbHzNB1K



PLATES (table is in inches)
JT TYPE PLATES W LEN Y X
F BMV1-p MT20 3.9 6.0
Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

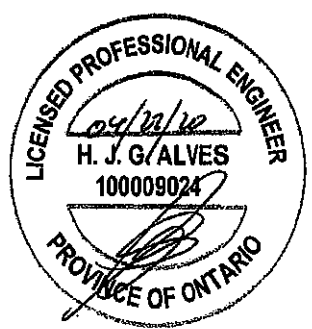

Structural component only
DWG# T-2007184 3/2

JOB NAME 408168	TRUSS NAME PB1	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:48 2020 Page 1
ID:DMCubINVR6TstFos31v6I_zns11-PDfyPME2p5alfFmuAaG4kD8hBP9Gw?nTyypaZzNBRN

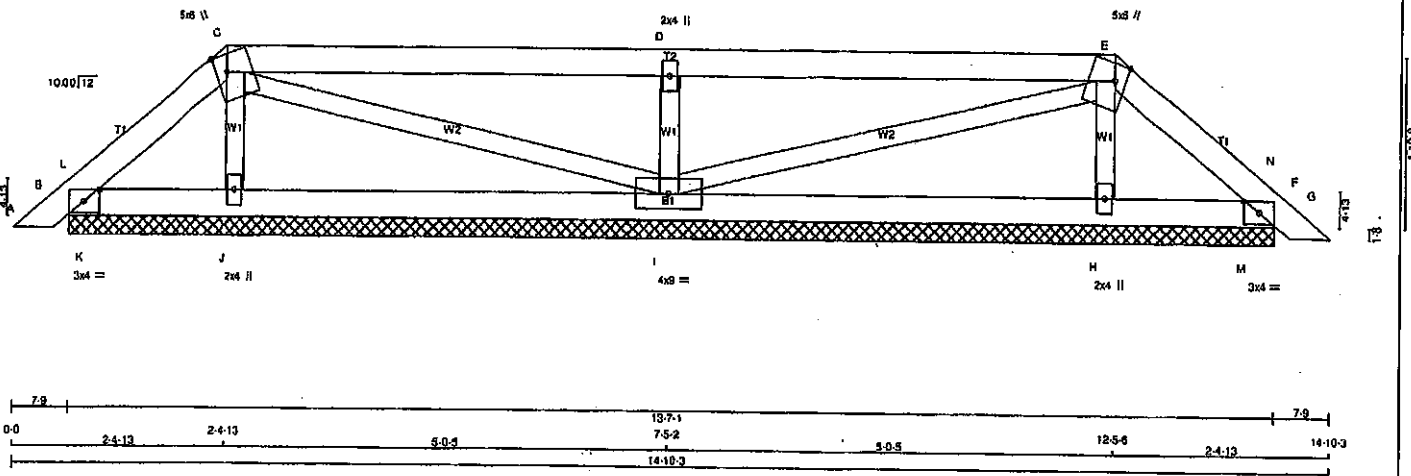

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
B - F	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

DESCR.
SPF
SPF
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ UPLIFT		
B	169	0	169	0	13-7-1	13-7-1
F	169	0	169	0	13-7-1	13-7-1
J	288	0	288	0	13-7-1	13-7-1
I	683	0	683	0	13-7-1	13-7-1
H	288	0	288	0	13-7-1	13-7-1

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
B	116	93/0	0/0	0/0	0/0	23/0	0/0
F	116	93/0	0/0	0/0	0/0	23/0	0/0
J	207	118/0	0/0	0/0	0/0	89/0	0/0
I	481	327/0	0/0	0/0	0/0	154/0	0/0
H	207	118/0	0/0	0/0	0/0	89/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F, J, I, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0/14	-91.8	-91.8 0.02 (1)	10.00	J-C	-194/0	0.03 (1)
B-L	-31/4	-91.8	-91.8 0.01 (1)	6.25	C-I	-22/0	0.01 (1)
L-C	-80/0	-91.8	-91.8 0.03 (1)	6.25	I-D	-578/0	0.08 (1)
C-D	-8/0	-91.8	-91.8 0.39 (1)	10.00	D-E	-22/0	0.01 (1)
D-E	-8/0	-91.8	-91.8 0.39 (1)	10.00	E-H	-194/0	0.03 (1)
E-N	-80/0	-91.8	-91.8 0.03 (1)	6.25	K-L	-121/0	0.00 (1)
N-F	-31/4	-91.8	-91.8 0.01 (1)	6.25	M-N	-121/0	0.00 (1)
F-G	0/14	-91.8	-91.8 0.02 (1)	10.00			
B-K	0/42	-18.5	-18.5 0.04 (1)	10.00			
K-J	0/42	-18.5	-18.5 0.07 (4)	10.00			
J-I	0/29	-18.5	-18.5 0.10 (4)	10.00			
I-H	0/29	-18.5	-18.5 0.10 (4)	10.00			
H-M	0/42	-18.5	-18.5 0.07 (4)	10.00			
M-F	0/42	-18.5	-18.5 0.04 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.39/1.00 (C-D:1), BC=0.10/1.00 (H-I:4), WB=0.08/1.00 (D-I:1), SSI=0.22/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRP(DRY) SHEAR SECTION
(PSD) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 610 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.39 (D) (INPUT = 0.90)
JSI METAL= 0.12 (D) (INPUT = 1.00)

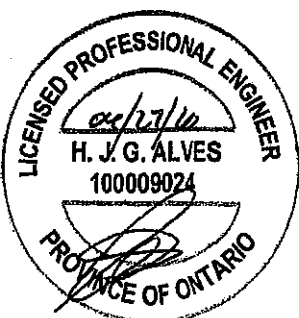

Structural component only
DWG# T-2007128

JOB NAME 408169	TRUSS NAME PB20	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 6.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 26 12:49:22 2020 Page 1
ID:K7TPdngj0npl1qVdbWfOFzIdG-mib6FuqXVexPlkFUY_VFTVITIPkW7jVf6AJozNBDh

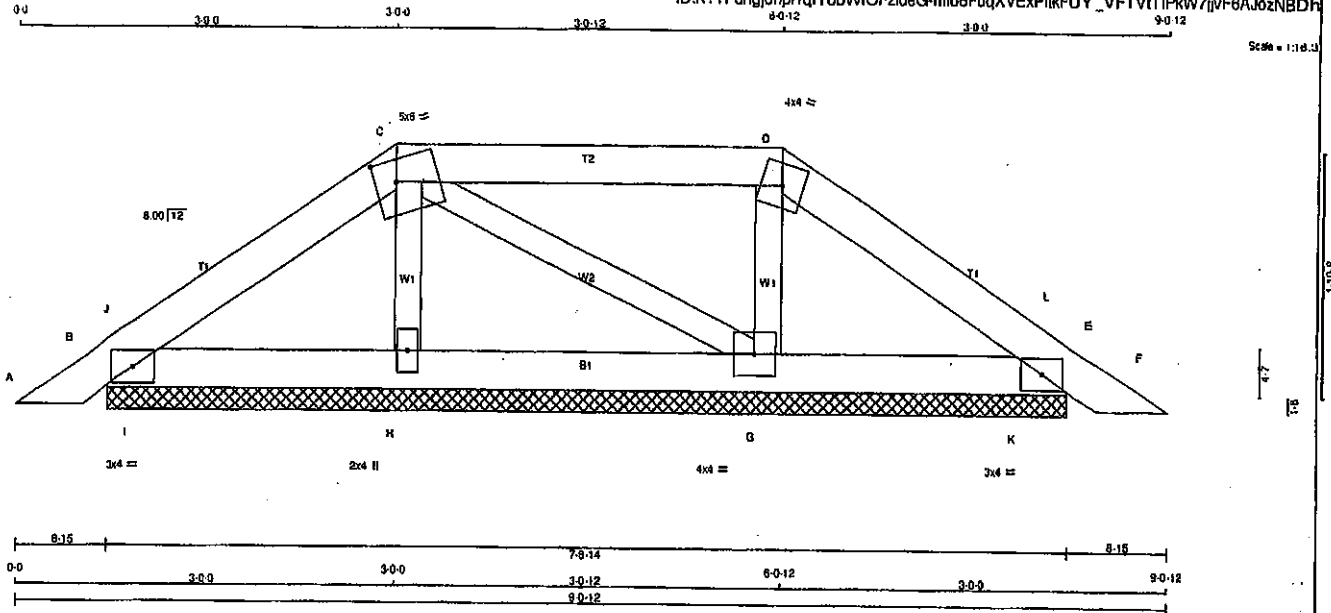

TOTAL WEIGHT = 3 X 25 = 75 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DRY
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
B	221	0	221	0	0	7-8-14	7-8-14
E	209	0	209	0	0	7-8-14	7-8-14
H	248	0	248	0	0	7-8-14	7-8-14
G	280	0	280	0	0	7-8-14	7-8-14

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 26.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.15/1.00 (C-D:1), BC=0.08/1.00 (B-I:1), WB=0.03/1.00 (D-G:1), SSI=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 6.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.90)
JSI METAL= 0.04 (B) (INPUT = 1.00)

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	3.0	4.0	
C	TTWW-m	MT20	5.0	8.0	2.00 2.00
D	TTW-m	MT20	4.0	4.0	
E	TMB1-I	MT20	3.0	4.0	
G	BMWV1-I	MT20	4.0	4.0	
H	BMW1-w	MT20	2.0	4.0	

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	154	113 / 0	0 / 0	0 / 0	0 / 0	41 / 0	0 / 0
E	146	108 / 0	0 / 0	0 / 0	0 / 0	39 / 0	0 / 0
H	176	109 / 0	0 / 0	0 / 0	0 / 0	67 / 0	0 / 0
G	198	127 / 0	0 / 0	0 / 0	0 / 0	71 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)


CHORDS				WEBS			
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED (LC)	MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 15	-91.8	-91.8 0.03 (1)	10.00	H-C	-176 / 0	0.03 (1)
B-J	-63 / 0	-91.8	-91.8 0.01 (1)	6.25	C-G	-21 / 0	0.00 (1)
J-C	-74 / 0	-91.8	-91.8 0.05 (1)	6.25	G-D	-198 / 0	0.03 (1)
C-D	-30 / 0	-91.8	-91.8 0.15 (1)	6.25	I-J	-121 / 0	0.00 (1)
D-L	-64 / 0	-91.8	-91.8 0.05 (1)	6.25	K-L	-123 / 0	0.00 (1)
L-E	-41 / 0	-91.8	-91.8 0.01 (1)	6.25			
E-F	0 / 15	-91.8	-91.8 0.03 (1)	10.00			
B-I	0 / 60	-18.5	-18.5 0.06 (1)	10.00			
I-H	0 / 60	-18.5	-18.5 0.06 (1)	10.00			
H-G	0 / 48	-18.5	-18.5 0.03 (1)	10.00			
G-K	0 / 43	-18.5	-18.5 0.06 (1)	10.00			
K-E	0 / 43	-18.5	-18.5 0.06 (1)	10.00			



Structural component only
DWG# T-2007144

JOB NAME 408168	TRUSS NAME J1	QUANTITY 19	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:43 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-7e_pnkBAWAC7oo1JURiN76ba9zNy3aYKn_h9zEzNBRO

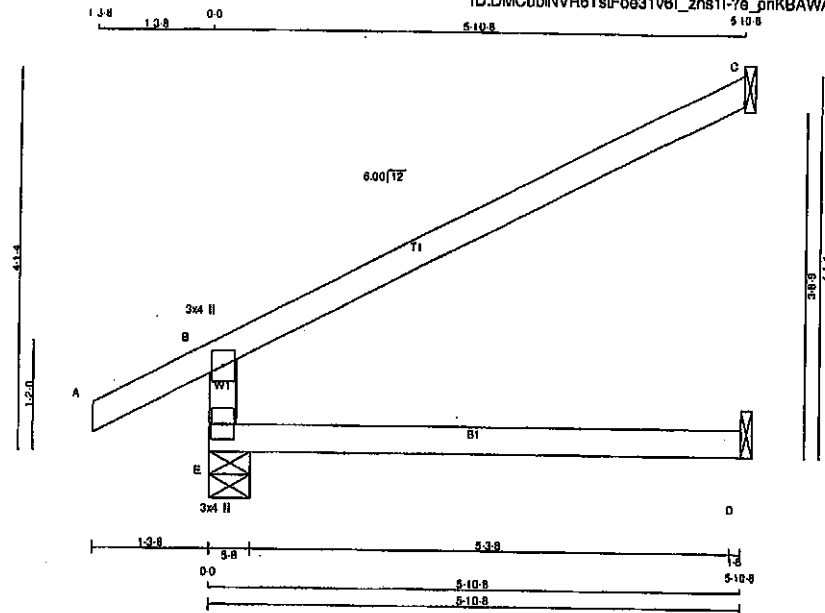

TOTAL WEIGHT = 19 X 17 = 319 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y
B	TMV-p	MT20	3.0	4.0	
E	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
GROSS REACTION		GROSS REACTION		BRG	BRG	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	525	0	525	0	0	5-8	5-8
C	202	0	202	0	0	1-8	1-8
D	45	0	50	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE
E	369	257/0	0/0
C	139	113/0	0/0
D	38	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LCI MAX	MAX. UNBRACED LENGTH	MEMB. MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO	CSI (LC)	FR-TO	
E-B	-461/0	0.0	0.0 0.13 (4)	7.81	
A-B	0/28	-91.8	-91.8 0.12 (1)	10.00	
B-C	-30/0	-91.8	-91.8 0.54 (1)	6.25	
E-D	0/0	-18.5	-18.5 0.13 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $\frac{1}{360}$ (0.20")
CALCULATED VERT. DEFL.(LL) = $\frac{1}{999}$ (0.00")
ALLOWABLE DEFL.(TL) = $\frac{1}{360}$ (0.20")
CALCULATED VERT. DEFL.(TL) = $\frac{1}{999}$ (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (A-D), SSI=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PU)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.19 (E) (INPUT = 0.90)
JSI METAL=0.13 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007126

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408168	J2	8	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 MITEK Industries, Inc. Sat Apr 25 12:34:44 2020 Page 1
ID:DMCubiNVR6TatFoe31v6I_zns1I-TrYB_gCoHTK_PxoV29DggJ8qrNjco1oU?eQjVhzNBRP

Scale = 1:11.5

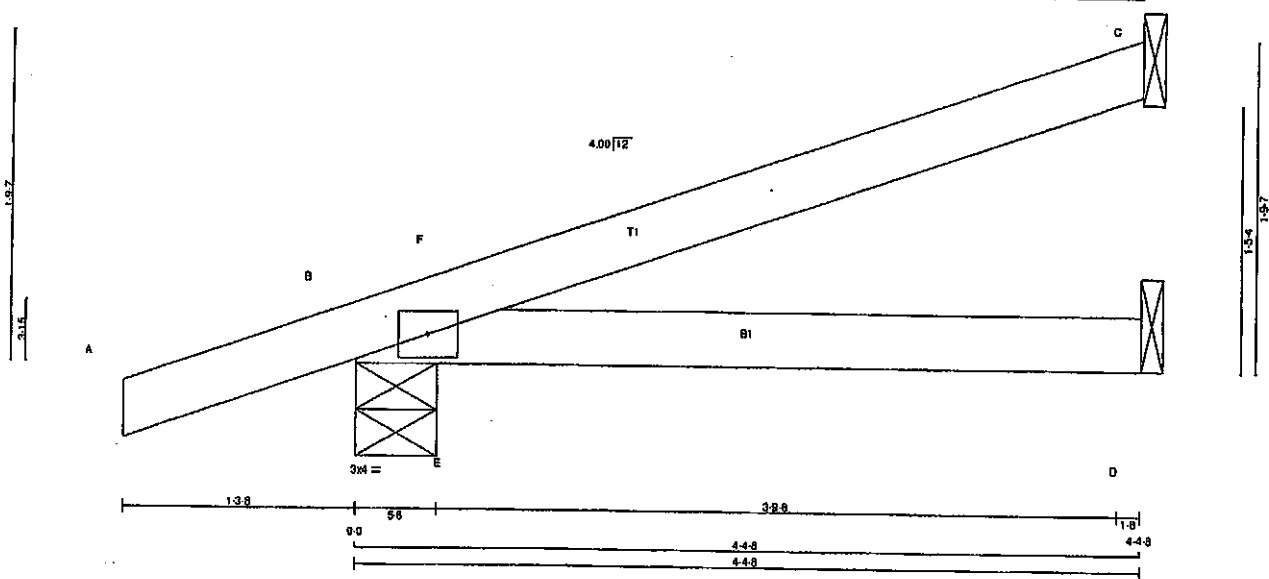

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE		LUMBER	DESCR.
A - C	2x4	DRY		No.2	SPF
B - D	2x4	DRY		No.2	SPF
DRY: SEASONED LUMBER.					

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ UPLIFT		
C	174	0	174	0	1-8	1-8
B	384	0	384	0	5-8	5-8
D	68	0	68	0	1-8	1-8

SEE MITEK STANDARD DETAIL B87791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX/MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
C	120	83/0	0/0	0/0	0/0	27/0	0/0
B	255	180/0	0/0	0/0	0/0	75/0	0/0
D	50	19/0	0/0	0/0	0/0	32/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED LC1 MAX (LBS)	FACTORED LC2 MAX (LBS)	MEMB. FORCE (LBS)	MAX. FACTORED FORCE (LBS)	FACTORED LC1 MAX (LBS)	FACTORED LC2 MAX (LBS)
FR-TO		FROM	TO		FR-TO		FROM	TO
A-B	0/18	-91.8	-91.8	0.11 (1)	10.00	E-F	-194/7	0.00 (1)
B-F	-14/0	-91.8	-91.8	0.05 (4)	6.25			
F-C	0/2	-91.8	-91.8	0.22 (1)	10.00			
B-E	0/0	-18.5	-18.5	0.17 (1)	10.00			
E-D	0/0	-18.5	-18.5	0.17 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.18")
CALCULATED VERT. DEFL.(LL) = $L/899$ (0.02")
ALLOWABLE DEFL.(TL) = $L/360$ (0.18")
CALCULATED VERT. DEFL.(TL) = $L/899$ (0.05")

CSI: TC=0.22/1.00 (C-F:1), BC=0.17/1.00 (D-E:1),
WB=0.00/1.00 (E-F:1), SSI=0.18/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN
MT20	618	354	1667	788	1887 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.24 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)

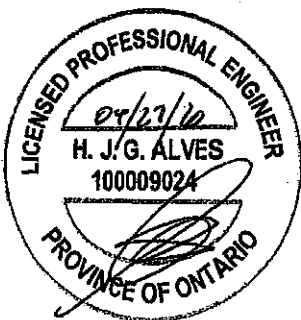

Structural component only
DWG# T-2007127

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408169	J20S	3	1	TRUSS DESC.		


Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 12:49:21 2020 Page 1

IDK7TPdngj0np11qYdbWfOFzldGIZ1k2YpvkxpY782wrSGiGzsv3mg3ZgbMdnLzNBD

1-3-8 0-0 2-5-8 2-5-8 1-5-0 3-10-8

Scale = 1/200

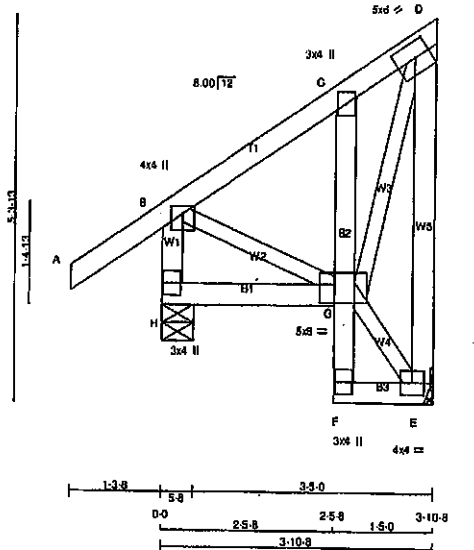

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
H - B	2x4	DRY	No.2
A - D	2x4	DRY	No.2
H - C	2x4	DRY	No.2
F - C	2x4	DRY	No.2
F - E	2x4	DRY	No.2
ALL WEBS EXCEPT E - D	2x3	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
C	TMVW+p	MT20	3.0	4.0	
D	TMVW-t	MT20	5.0	8.0	2.50 2.50
E	BMVW-t	MT20	4.0	4.0	
F	BMVW+p	MT20	3.0	4.0	
G	BMVWVW-t	MT20	5.0	8.0	3.00 2.50
H	BMVW+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
H	332	0	332	0	5-8	5-8	
E	208	0	208	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	232	168 / 0	0 / 0	0 / 0	0 / 0	68 / 0	0 / 0
E	145	95 / 0	0 / 0	0 / 0	0 / 0	50 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. (PLF)	FACTORED LC1 MAX CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)	
FR-TO		FROM TO		FR-TO			
H-B	-307 / 0	0.0	0.0 0.03 (1)	B-G	0 / 89	0.02 (1)	
A-B	0 / 35	-91.8	-91.8 0.14 (5)	E-D	-184 / 0	0.05 (1)	
B-C	-83 / 0	-91.8	-91.8 0.07 (1)	G-E	-14 / 0	0.00 (1)	
C-D	-100 / 0	-91.8	-91.8 0.06 (1)	G-D	0 / 220	0.05 (1)	
H-G	0 / 0	-18.5	-18.5 0.04 (4)				
F-G	0 / 12	0.0	0.0 0.02 (1)				
G-C	-218 / 0	0.0	0.0 0.02 (1)				
F-E	0 / 9	-18.5	-18.5 0.01 (4)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 29 = 86 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2016, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/889 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/889 (0.00")

CSI: TC=0.14/1.00 (A-B:5), BC=0.04/1.00 (G-H:4), WB=0.05/1.00 (D-E:1), SS=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION	(PS)	(PL)
MT20	618	354	1667	788	1967 1665


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.90)
JSI METAL = 0.07 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007143

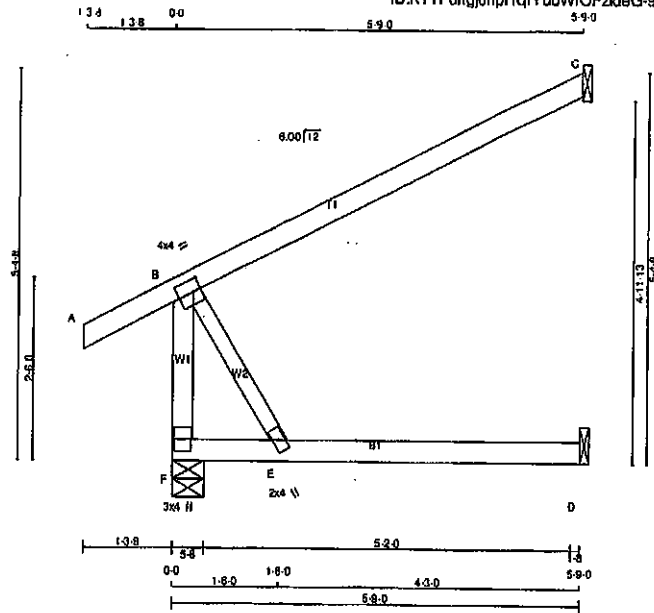

Scale = 1:29.2

TOTAL WEIGHT = 20 lb

LUMBER					
N. L. G. A. RULE					
CHORDS	SIZE		LUMBER		DESCR
F - B	2x4	DRY	No.2		SPF
A - C	2x4	DRY	No.2		SPF
F - D	2x4	DRY	No.2		SPF
ALL WEBS	2x3	DRY	No.2		SPF
DRY: SEASONED LUMBER.					

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	4.0	4.0	200 1.25
E	BMV+ww	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

	FACTORED		MAXIMUM FACTORED		INPUT	REQD
	GROSS REACTION		GROSS REACTION		BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
F	441	0	441	0	0	5-8
C	284	0	284	0	0	1-8
D	53	0	60	0	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	310	217 / 0	0 / 0	0 / 0	0 / 0	93 / 0	0 / 0
C	182	147 / 0	0 / 0	0 / 0	0 / 0	35 / 0	0 / 0
D	43	0 / 0	0 / 0	0 / 0	0 / 0	43 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)
FR-TO		FROM	TO	FR-TO			
F-B	-389 / 0	0.0	0.0	0.05 (1)	7.81	B-E	0 / 0
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00		
B-C	0 / 0	-91.8	-91.8	0.52 (1)	10.00		
F-E	0 / 0	-18.5	-18.5	0.14 (4)	10.00		
E-D	0 / 0	-18.5	-18.5	0.18 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.06")

CSI: TC=0.52/1.00 (B-C:1), BC=0.16/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.24 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007167

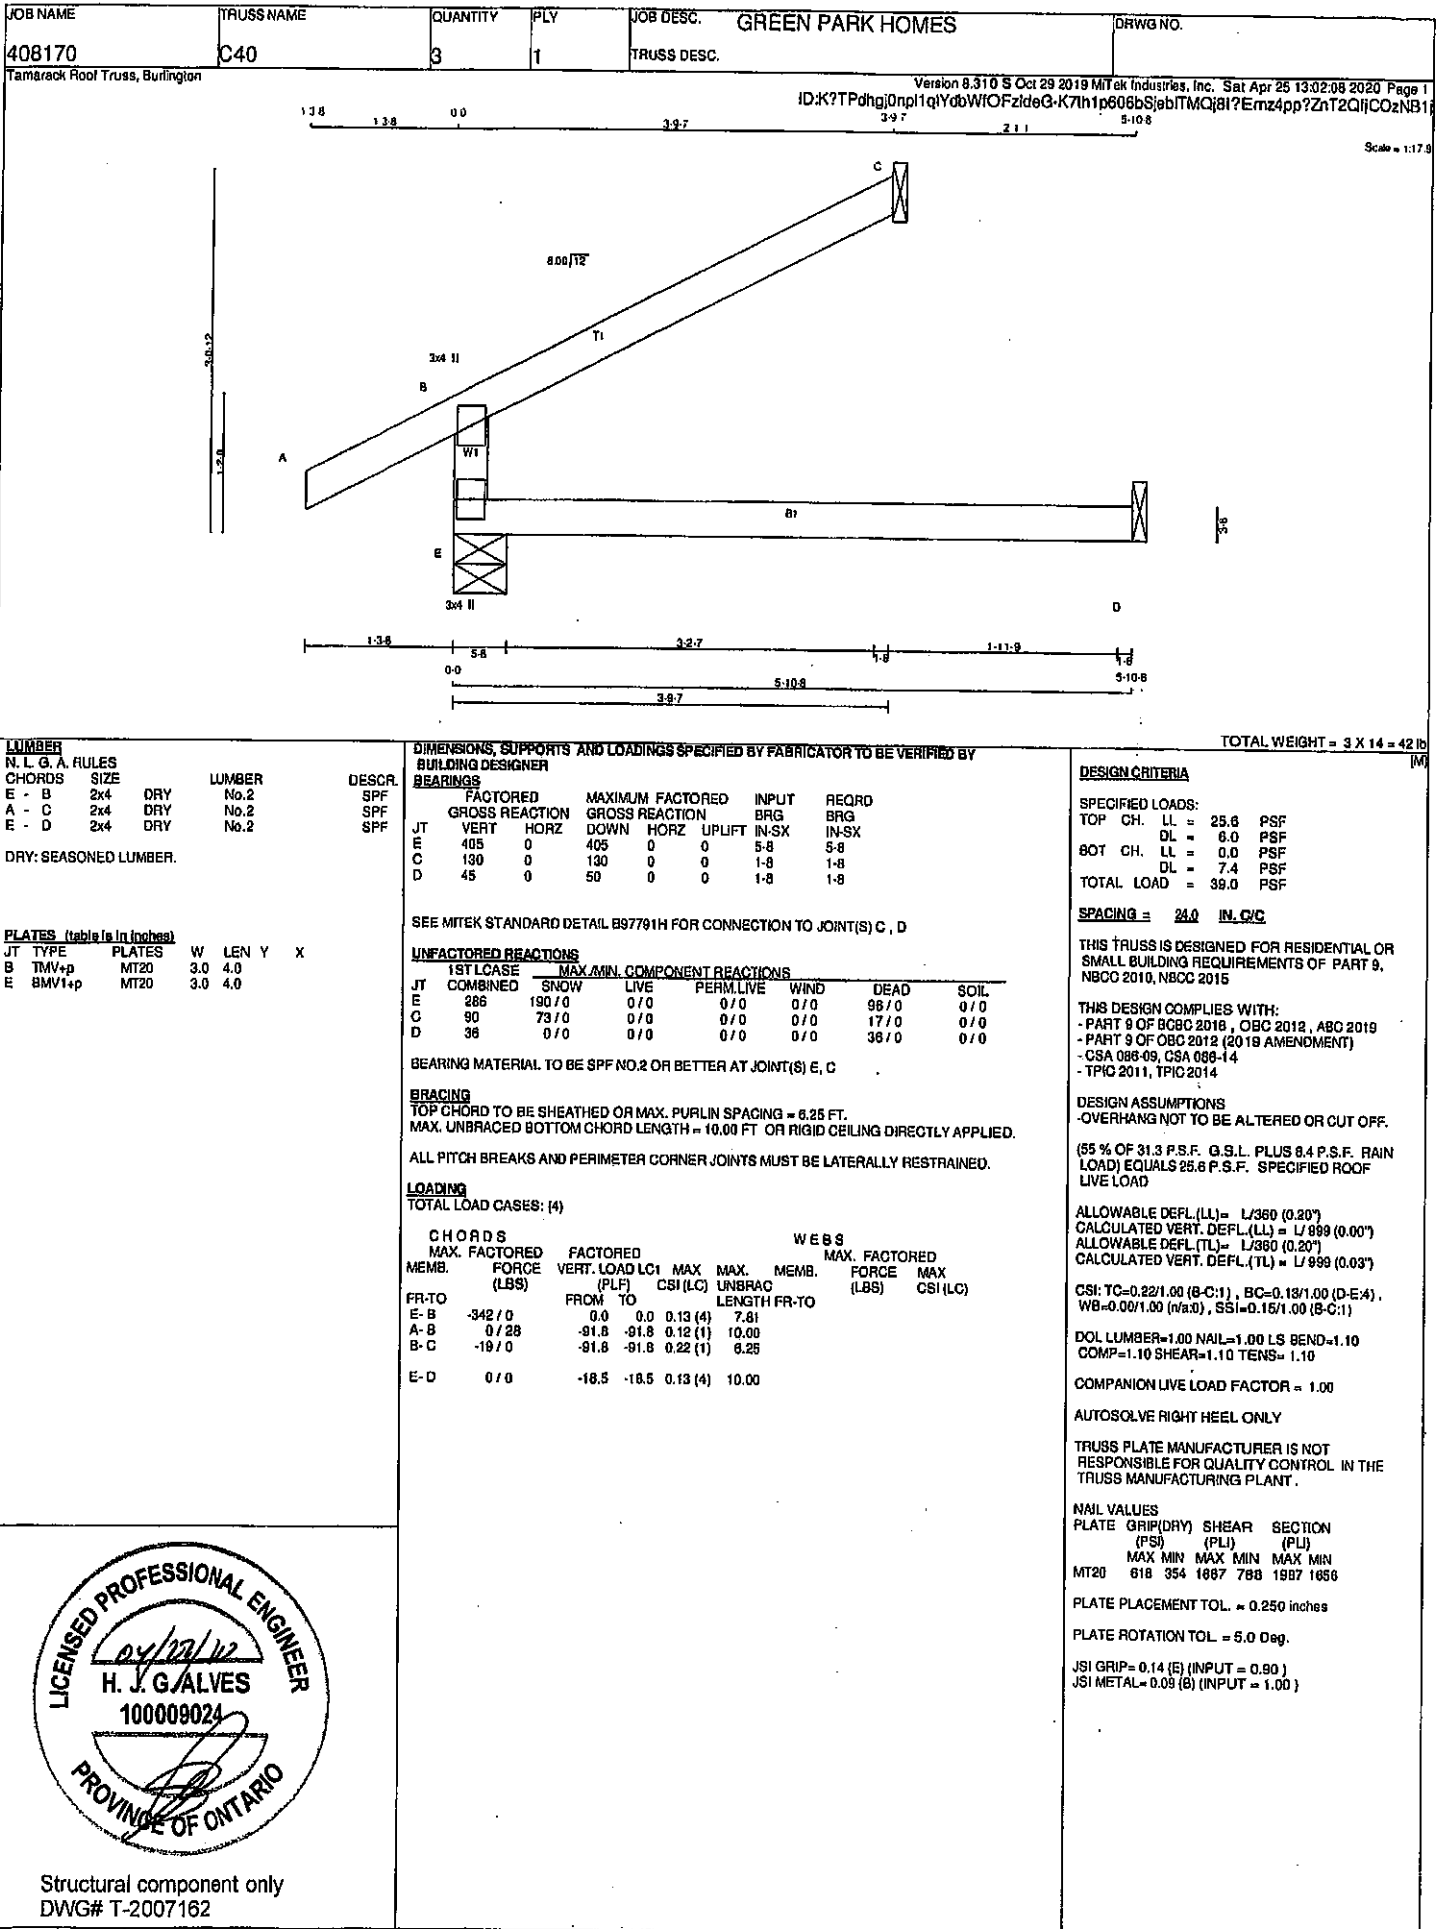

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	C41	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:09 2020 Page 1			
		ID:K?TPdhgj0npl1qYdbWfOfzIdeG-pJR3E96etvaaGltw7ENrDmzlU9yK0tG4PGkrzNB1i			

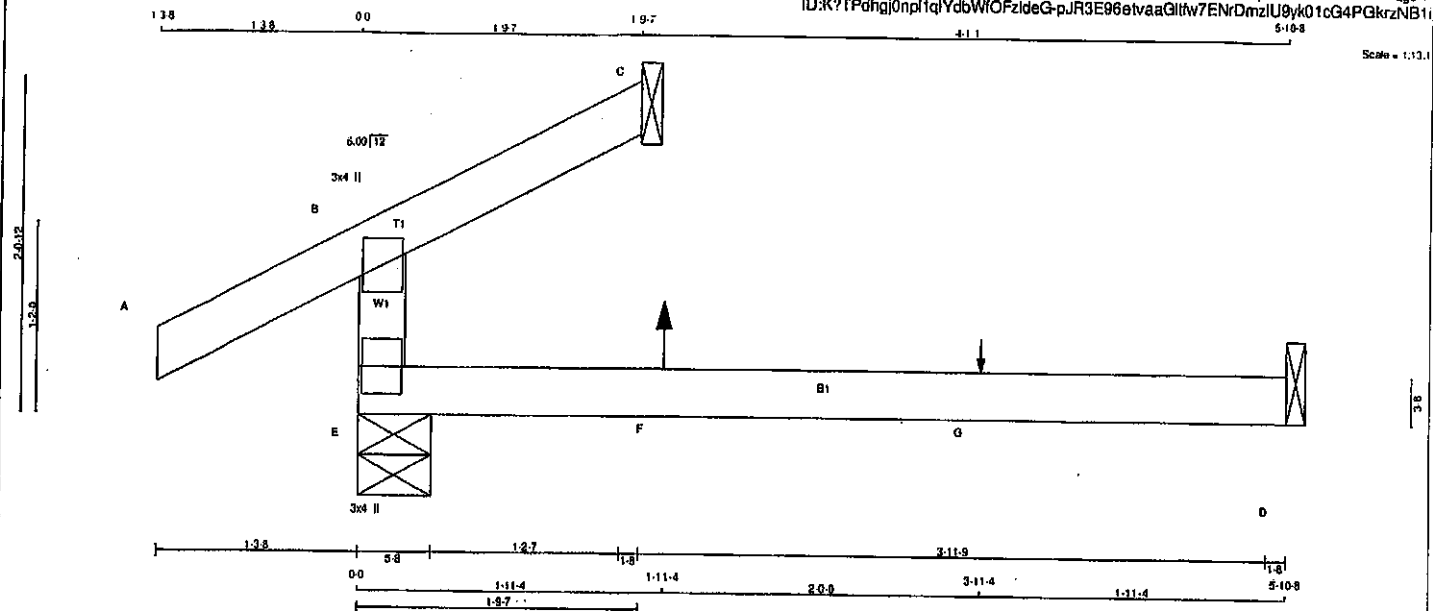

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)			
JT	TYPE	PLATES	W LEN Y X
B	TMV+p	MT20	3.0 4.0
E	BMV+p	MT20	3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
E	284	0	284	0	5-8
C	63	0	63	0	1-8
D	44	0	52	0	1-8

SEE MITEK STANDARD DETAIL 887791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	200	137/0	0/0	0/0	0/0	62/0	0/0
C	48	21/0	0/0	0/0	0/0	25/0	0/0
D	35	0/3	0/0	0/0	0/0	37/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (7)

CHORDS		WEBS	
MEMB.	MAX. FACTORED	MEMB.	MAX. FACTORED
	FORCE		FORCE
	(LBS)		(LBS)
	VERT. LOAD		VERT. LOAD
	(PLF)		(PLF)
	FROM TO		FROM TO
E-B	-227/0	0.0	0.0
A-B	0/28	-91.8	-91.8
B-C	-9/9	-91.8	-91.8
E-F	0/0	-18.5	-18.5
F-G	0/0	-18.5	-18.5
G-D	0/0	-18.5	-18.5

FACTORED CONCENTRATED LOADS (LBS)		LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11-4	7	1	12	BACK	VERT	TOTAL	--	C1	
G	3-11-4	1	1	--	BACK	VERT	TOTAL	--	C1	

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 3 X 12 = 35 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS=0.08/1.00 (A-B:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007163

JOB NAME 408170	TRUSS NAME C42	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:10 2020 Page 1			
		ID:K?TPdngj0npl1qYdbWIOFzIdeG-HV?SRV7GeCiRuvRrTricNQJ6SuVW4TTHmVk8pHHzNB1h			

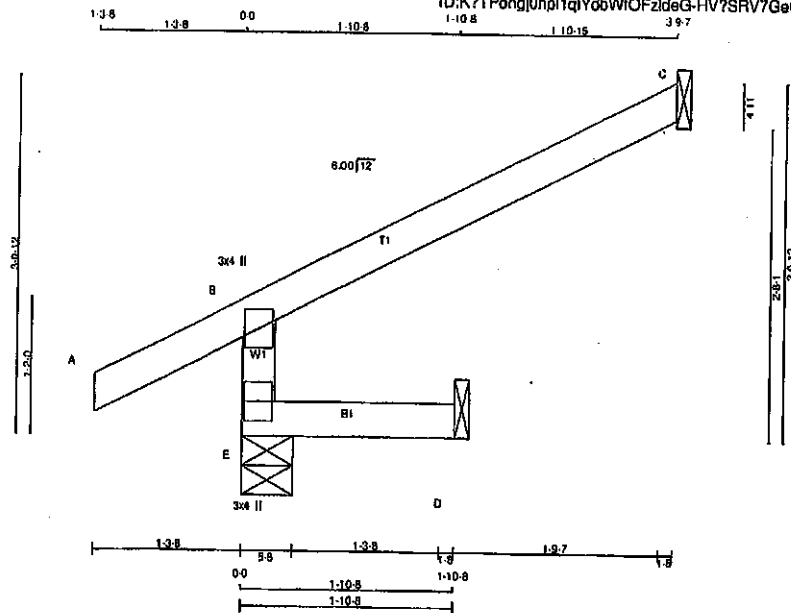

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY, SEASONED LUMBER.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERY	HORZ	DOWN	HORZ	UPLIFT
E	361	0	361	0	5-8
C	130	0	130	0	1-8
D	16	0	17	0	1-8

SEE MITEK STANDARD DETAIL B87791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST LCASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
E	250	190/0	0/0
C	90	73/0	0/0
D	12	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
B-B	-342/0	B-B	0.0
A-B	0/26	A-B	-01.8
B-C	-19/0	B-C	-01.8
E-D	0/0	E-D	-18.5

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 10 = 29 lb [M]

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBCG 2018, CBCG 2012, ABC 2019
- PART 9 OF CBCG 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (A-B:0), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.09 (E) (INPUT = 1.00)



Structural component only
DWG# T-2007164

JOB NAME

408170

TRUSS NAME

C43

QUANTITY

3

PLY

1

JOB DESC.

GREEN PARK HOMES

TRUSS DESC.

DRWG NO.

Tamarack Roof Truss, Burlington

Version 8.310.5 Oct 29 2019 MITek Industries, Inc. Sat Apr 25 13:02:11 2020 Page 1

ID:K?TPdgi0npl1qYdbWOFzIdeG-lIZqk8uPWqIV2011YHrwesJqls_CwXvkOuNpizNB1g

Scale = 1:12.1

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
E	271	0	271	0
C	45	0	45	0
D	8	0	17	0

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 160 LBS FACTORED UPLIFT

PROVIDE ANCHORAGE AT BEARING JOINT D FOR 160 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	188	141 / 0	0 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0
C	31	24 / -18	0 / 0	0 / 0	0 / 0	0 / 0	7 / 0	0 / 0
D	7	0 / -8	0 / 0	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)
FR-TO						FR-TO		
E-B	-244 / 0	0.0	0.0	0.04 (5)	7.81			
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00			
B-C	-17 / 0	-91.8	-91.8	0.09 (1)	8.25			
E-D	0 / 0	-18.5	-18.5	0.04 (5)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")

CALCULATED VERT. DEFL.(LL) = L/999 (0.00")

ALLOWABLE DEFL.(TL) = L/360 (0.19")

CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSR: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5), WB=0.00/1.00 (NA:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION (PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	816 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)

JSI METAL = 0.07 (B) (INPUT = 1.00)

09/12/20

H. J. G. ALVES

100009024

LICENSED PROFESSIONAL ENGINEER

PROVINCE OF ONTARIO

Structural component only

DWG# T-2007165

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.


Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.

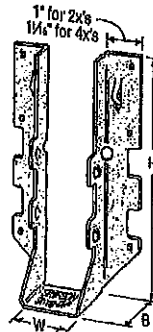


LUS28




LU26L

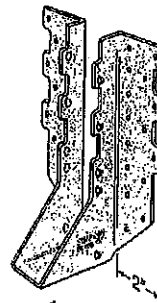

HUS210
(HUS26, HUS28,
and HHUS similar)




HGUS28-2



HHUS210-2



Double-Shear
Nailing
Top View





Double-Shear
Nailing
Side View;
Do not
bend tab



Dome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,580

Typical HUS28
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

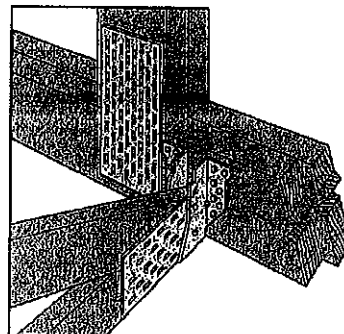

LJS26DS

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.82 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value

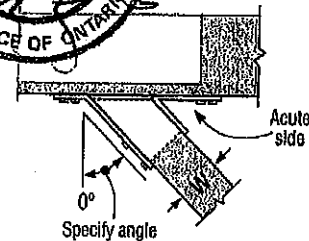

Top View HHUS Hanger Skewed Right
(joist must be bevel cut)
All joist nails installed on the outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance				
		W	H	B	d _g ³	Header	Joist	D-Fir-L		S-P-F		
								Uplift	Normal	Uplift	Normal	
								(K _D = 1.15) lb.	(K _D = 1.00) lb.	(K _D = 1.15) lb.	(K _D = 1.00) lb.	
								kN	kN	kN	kN	
Single 2x Sizes												
■	LUS24	18	1 1/8	3 3/4	1 3/4	2 1/2	(4) 10d	(2) 10d	710	1625	645	1155
									3.16	7.23	2.87	5.14
■	LU24L	22	1 1/8	3	1 1/2	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360	1020	320	725
									1.60	4.54	1.42	3.22
■	LU26L	22	1 1/8	5	1 1/2	4 3/4	(6) 10d	(4) 10d x 1 1/2"	720	1605	645	1140
									3.20	7.14	2.87	5.07
SS	LUS26	18	1 1/8	4 3/4	1 1/2	3 3/4	(4) 10d	(4) 10d	1420	2170	1290	1630
									6.32	9.85	5.74	7.25
■	HUS26	16	1 1/8	5 3/4	3	3 3/8	(14) 16d	(6) 16d	2705	4940	2065	3875
									11.90	21.97	9.20	17.24
■	LJS26DS	18	1 1/8	5	3 1/2	4 3/4	(16) 16d	(6) 16d	2055	4285	1460	4115
									9.14	18.97	6.49	18.31
■	HGUS26	12	1 1/8	5 3/4	5	4 3/4	(20) 16d	(8) 16d	2885	6625	2685	5700
									11.96	29.51	11.96	25.35
■	LU28L	20	1 1/8	6 3/4	1 1/2	5 3/4	(8) 10d	(6) 10d x 1 1/2"	1140	2185	1020	1550
									5.07	9.72	4.54	8.89
SS	LUS28	18	1 1/8	6 3/4	1 1/2	3 3/4	(6) 10d	(4) 10d	1420	2520	1290	1790
									6.32	11.21	5.74	7.96
■	HUS28	16	1 1/8	7 1/8	3	6 3/8	(22) 16d	(8) 16d	3605	5365	2675	4345
									16.04	23.88	11.90	19.33
■	HGUS28	12	1 1/8	7 1/8	5	6 3/4	(36) 16d	(12) 16d	3310	7675	3310	6900
									14.74	34.19	14.74	30.73
■	LU210L	20	1 1/8	8	1 1/2	7 3/4	(10) 10d	(6) 10d x 1 1/2"	1140	2495	1020	1770
									5.07	11.10	4.54	7.87
SS	LUS210	18	1 1/8	7 1/8	1 1/2	3 3/4	(8) 10d	(4) 10d	1420	2785	1290	2210
									6.32	12.39	5.74	9.83

1. Factored uplift resistances have been increased 16% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSON and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 3/4" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers


SIMPSON
Strong-Tie

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ¹	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _g = 1.15)	(K _g = 1.00)	(K _g = 1.15)	(K _g = 1.00)
								lb.	lb.	lb.	lb.
								kN	kN	kN	kN
Double 2x Sizes											
LUS24-2	18	3 3/8	3 3/8	2	1 1/2	(4) 16d	(2) 16d	835	2020	590	1435
								3.71	8.99	2.62	6.38
SS LUS26-2	18	3 3/8	4 3/8	2	4	(4) 16d	(4) 16d	1720	2595	1545	1920
								7.65	11.54	6.87	8.54
HHUS26-2	14	3 3/8	5 3/8	3	3 3/8	(14) 16d	(6) 16d	2850	7335	2065	5205
								12.68	32.63	9.20	23.15
HGUS26-2	12	3 3/8	5 3/8	4	4 3/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
SS LUS28-2	18	3 3/8	7	2	4	(6) 16d	(4) 16d	1720	3325	1545	2575
								7.65	14.79	6.87	11.45
HHUS28-2	14	3 3/8	7 3/8	3	6 3/8	(22) 16d	(8) 16d	3765	8940	2675	6345
								16.75	39.77	11.90	28.22
HGUS28-2	12	3 3/8	7 3/8	4	8 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
SS LUS210-2	18	3 3/8	9	2	8	(8) 16d	(6) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HHUS210-2	14	3 3/8	9 3/8	3	8	(30) 16d	(10) 16d	4670	9680	4235	7000
								20.77	42.97	18.84	31.14
HGUS210-2	12	3 3/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-3	12	4 1/8	7 1/8	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	4670	9670	4235	6865
								20.77	43.02	18.84	30.54
HGUS210-3	12	4 1/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
Quadruple 2x Sizes											
HGUS26-4	12	6 3/8	6 3/8	4	4 3/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-4	12	6 3/8	7 3/8	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-4	14	6 3/8	8 3/8	3	7 3/8	(30) 16d	(10) 16d	4670	10155	4235	7210
								20.77	45.17	18.84	32.07
HGUS210-4	12	6 3/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
HGUS212-4	12	6 3/8	10 3/8	4	10 3/8	(56) 16d	(20) 16d	7640	14985	5425	10645
								33.98	66.70	24.13	47.35
HGUS214-4	12	6 3/8	12 3/8	4	11 3/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80
4x Sizes											
LUS46	18	3 3/8	4 3/8	2	3 3/8	(4) 16d	(4) 16d	1720	2595	1545	1920
								7.65	11.54	6.87	8.54
HHUS46	14	3 3/8	5 3/8	3	3 3/8	(14) 16d	(6) 16d	2540	7335	2065	5205
								11.30	32.63	9.20	23.15
HGUS46	12	3 3/8	5 3/8	4	4 3/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
LUS48	18	3 3/8	6 3/8	2	3 3/8	(6) 16d	(4) 16d	1720	3325	1545	2575
								7.65	14.79	6.87	11.45
HHUS48	14	3 3/8	7 3/8	3	6 3/8	(22) 16d	(8) 16d	3765	8940	2675	6345
								16.75	39.77	11.90	28.22
HGUS48	12	3 3/8	7 3/8	4	8 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
LUS410	18	3 3/8	8 3/8	2	5 3/8	(8) 16d	(6) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HGUS410	12	3 3/8	9	4	8 3/8	(46) 16d	(16) 16d	6840	14015	4855	10270
								30.43	62.34	21.60	45.69
HGUS412	12	3 3/8	10 3/8	4	10 3/8	(56) 16d	(20) 16d	7640	14985	5425	10645
								33.98	66.70	24.13	47.35
HGUS414	12	3 3/8	12 3/8	4	11 3/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80

See footnotes
on p. 258.



Plated Truss Connectors

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

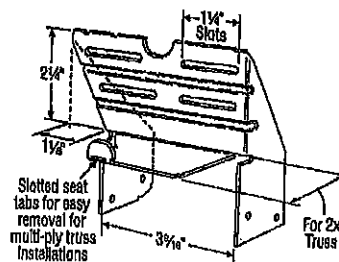


TC24
U.S. Patent 4,932,173

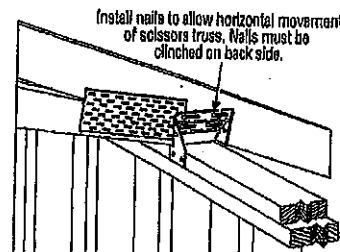


Typical TC24 Installation

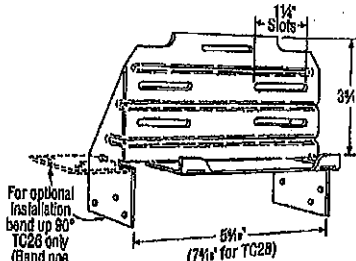

TC26
(TC28 Similar)

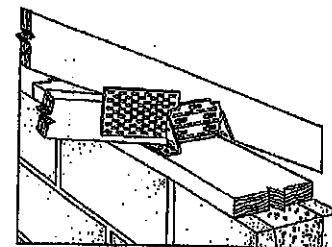

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer
(8", 10", 12" Wall Installation Similar)

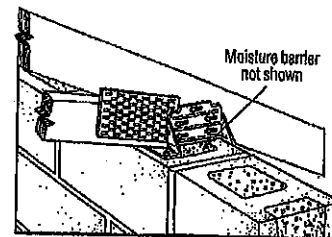

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift ($K_p=1.15$)	Uplift ($K_p=1.15$)
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(5) 10d	1015	720
TC28	(5) 10d	(5) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift ($K_p=1.15$)	Uplift ($K_p=1.15$)
TC26	(5) 10d	(5) 10d x 1 1/2"	810	660
	(5) 10d	(5) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.
4. TC26 fastened to grouted concrete block with (5) - 3/8" x 2 1/4" Titen screws has a factored uplift resistance of 275 lb.



SIMPSON
STRONG-TIE

© 2014 Simpson Strong-Tie Company

SP-24-17-12-0000-0000

(800) 999-5099
strongtie.com

H/TSP

SIMPSON
Strong-Tie

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_D = 1.15$)					
					D-Fir-L			S-P-F		
		To Rafters/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(8) 8d x 1 1/2"	(4) 8d	—	740	685	300	680	485	215
					3.29	3.05	1.33	3.02	2.16	0.98
SS H2A	18	(5) 8d x 1 1/2"	(2) 8d x 1 1/2"	(5) 8d x 1 1/2"	830	220	75	590	155	65
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
					3.58	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	265	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ³	18	(5) 10d x 1 1/2"	(5) 10d x 1 1/2"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A ³	18	(9) 10d x 1 1/2"	(9) 10d x 1 1/2"	—	1735	795	410	1505	565	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1 1/2"	(9) 10d x 1 1/2"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1 1/2"	(9) 10d x 1 1/2"	—	1835	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^{3,4}	18	(8) 8d x 1 1/2"	(8) 8d x 1 1/2"	(8) 8d	1465	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2 1/4"	(6) 16d x 2 1/4"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1 1/2"	(13) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
		[2] (12) 8d x 1 1/2"	(15) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
TSP	18	(9) 10d x 1 1/2"	(6) 10d x 1 1/2"	—	1295	440	—	920	310	—
					5.76	1.96	—	4.09	1.38	—
		(9) 10d x 1 1/2"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.98	—	4.92	1.38	—

- Factored resistances have been increased 16% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2 1/2" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 695 lb. (2.65 kN) for D-Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D-Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.76. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILLS at strongtie.com.
- D-Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1 1/2" nails into the top plates and (3) 8d x 1 1/2" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2 1/4" = 0.162" dia. x 2 1/4" long, 10d = 0.148" dia. x 3" long, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long, 8d = 0.131" dia. x 2 1/2" long, 8d x 1 1/2" = 0.131" dia. x 1 1/2" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

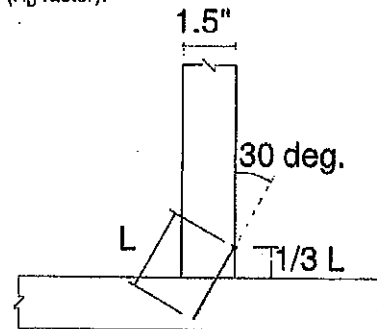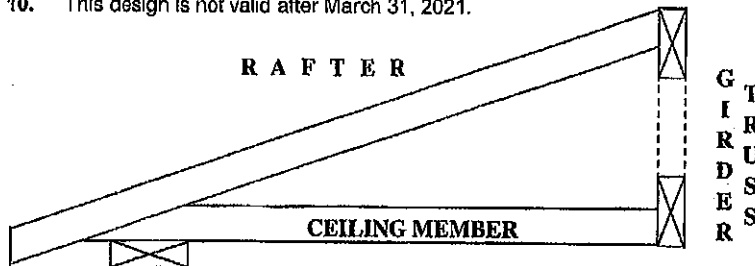


TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

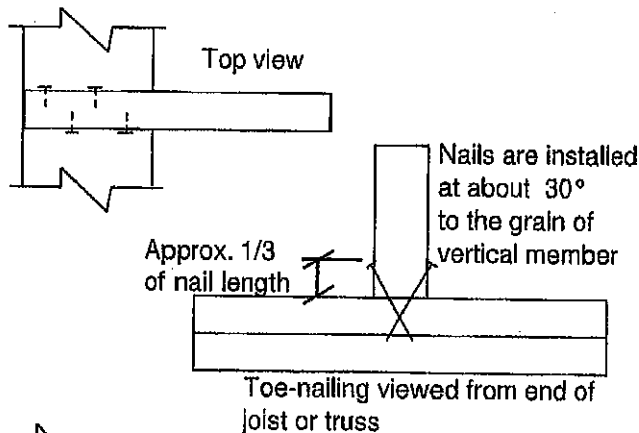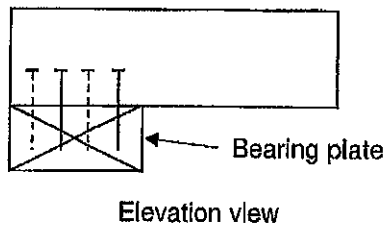

Toe-nailing on 2x4 Bearing Plate

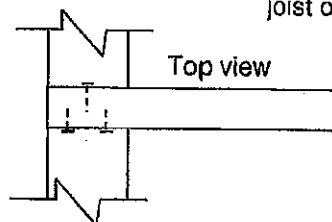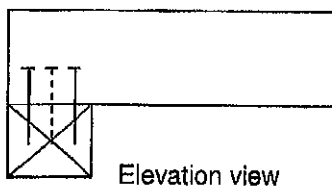

PEO
Certificate No. 10888485





MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



For 4 x 2 orientation, locate plates 0-1/4\" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.

Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

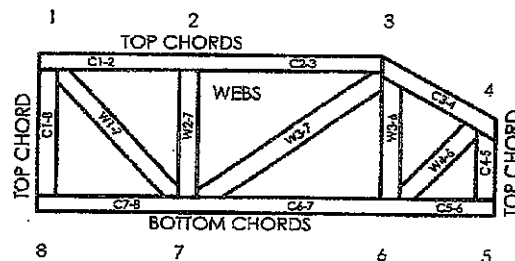

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MIT-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

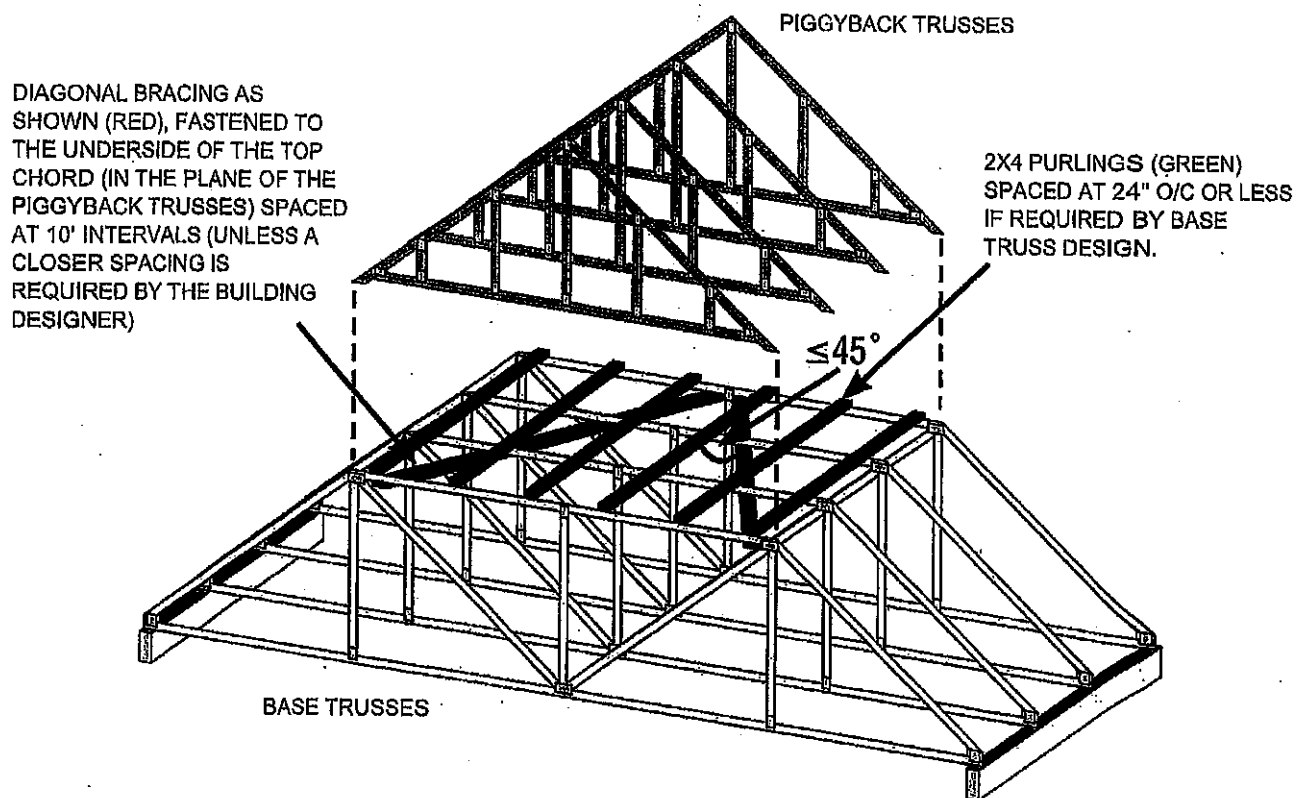


NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1900213

Feb 09, 2018