

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012
(2019 amendment) OCCUPANCY:
RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:

TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE

LUS24 - (O)

LJS26DS - (V)

HGUS26-2 -

LUS26-2-(VV)


BEAMS:

B30 = B31 =

2 - 2x10 SPF #2

 **DENOTES:**
CONVENTIONAL
FRAMING

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department
FEB 04 2021
REC'D BY _____ DATE _____
REF'D TO _____ DATE _____

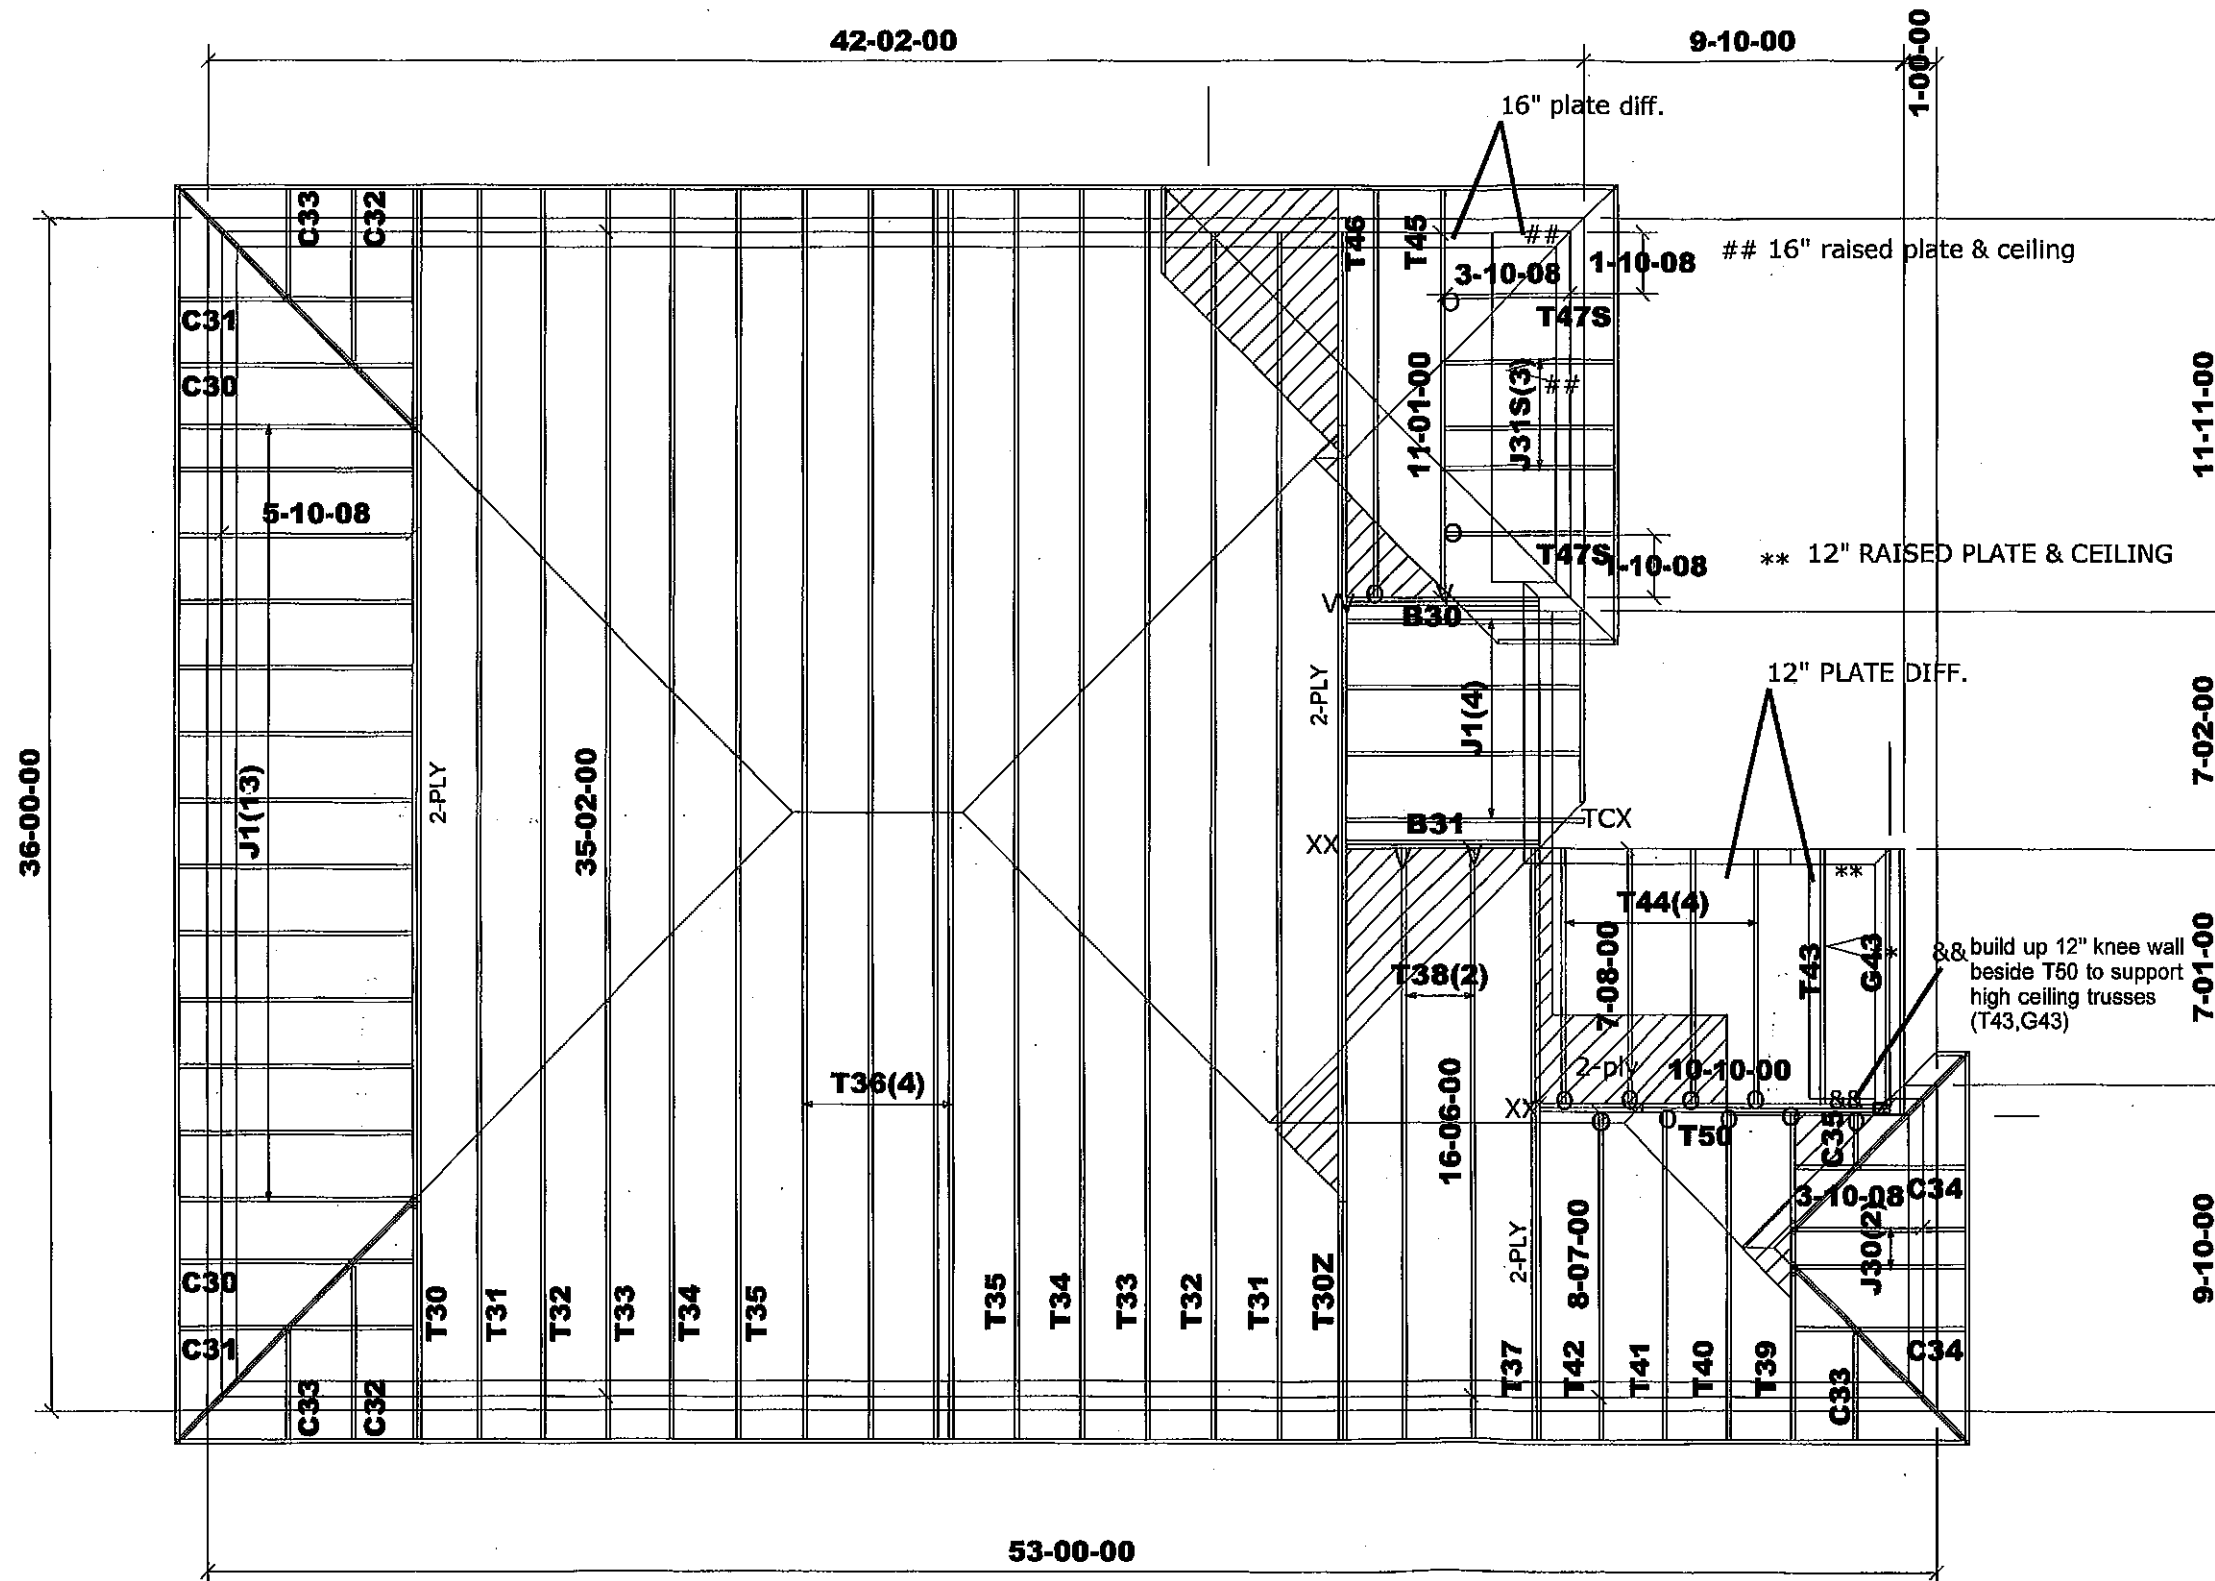

M13/24

Job Track: **51225**Plan Log: **202395**

Layout ID: 408133

Builder / Location:	
---------------------	--

GREEN PARK HOMES / WATERDOWN

Project: **RUSSELL GARDENS PH.3**

Date: 2020-04-27

Sales: **Mario DiCarno**

Designer: JG

Model / Elevation:

MOUNTAINASH 3/3- STD OR OPT.5 BR

Milek ver
LOT 229

Milek ver 8.3.1.215

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 3
 Lot #: 229
 Elevation: 3- STD OR OPT.5 BR


Job Track: 51225
 Plan Log: 202395
 Layout ID: 408133
 Ref #
 Page: 1 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBG. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T30 Hip Girder	6 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	337.56 208.00		
	1 2-ply	T30Z Hip Girder	6 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	337.56 208.00		
	2	T31 Hip	6 /12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.96 174.00		
	2	T32 Hip	6 /12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.1 174.67		
	2	T33 Hip	6 /12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	289.05 179.67		
	2	T34 Hip	6 /12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	290.71 183.33		
	2	T35 Hip	6 /12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	301.64 191.33		
	4	T36 Common	6 /12	35-02-00	9-11-08	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	606.72 372.00		
	1 2-ply	T37 Common Girder	6 /12	16-06-00	5-03-08	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	158.36 98.00		
	2	T38 Common	6 /12	16-06-00	5-03-08	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	132.54 82.67		
	1	T39 Hip Girder	6 /12	8-07-00	3-01-04	2 x 4	1-03-08	1-02-00 1-04-08	36.28 24.50		
	1	T40 Half Hip	6 /12	8-07-00	3-07-04	2 x 4	1-03-08	1-02-00 3-07-04	36.11 24.33		
	1	T41 Half Hip	6 /12	8-07-00	4-07-04	2 x 4	1-03-08	1-02-00 4-07-04	40.96 27.50		
	1	T42 Common	6 /12	8-07-00	5-03-08	2 x 4	1-03-08	1-02-00 5-01-08	37.97 24.00		

 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST				Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 3 Lot #: 229 Elevation: 3- STD OR OPT.5 BR		Job Track: 51225 PlanLog: 202395 Layout ID: 408133 Ref # Page: 2 of 3 Date: 04-27-2020 Designer: Sales Rep: Mario DiCano	
--	-------------------	--	--	--	--	--	---	--

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T43 Flat	0 /12	7-08-00	2-08-00	2 x 4		2-08-00 2-08-00	30.48 21.17		
	1	G43 GABLE	0 /12	7-08-00	2-08-00	2 x 4		2-08-00 2-08-00	27.33 19.17		
	4	T44 Flat	0 /12	7-08-00	3-08-00	2 x 4		3-08-00 3-08-00	138.2 92.00		
	1	T45 Hip Girder	6 /12	11-01-00	4-05-04	2 x 4	1-03-08 1-03-08	2-06-00 2-06-00	51.49 34.17		
	1	T46 Hip	6 /12	11-01-00	5-00-08	2 x 4	1-03-08 1-03-08	2-06-00 2-06-00	51.04 34.33		
	2	T47S Half Hip	6 /12	3-10-08	3-05-04	2 x 4	1-03-08	1-02-00 3-05-04	48.24 33.00		
	1 2-ply	T50 Half Hip Girder	6 /12	10-10-00	5-00-00	2 x 4 2 x 6		1-02-00 5-00-00	109.49 73.00		
	17	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	285.47 181.33		
	2	J30 Jack-Open	6 /12	3-10-08	3-01-04	2 x 4	1-03-08	1-02-00 3-01-04	23.93 14.67		
	3	J31S Jack-Open	6 /12	3-10-08	4-05-04	2 x 4	1-03-08	1-02-00 4-05-04	75.74 52.00		
	2	C30 Jack-Open	6 /12	3-11-00	3-01-08	2 x 4	1-03-08 1-11-08	1-02-00 3-01-08	28.59 17.33		
	2	C31 Jack-Open	6 /12	1-11-00	2-01-08	2 x 4	1-03-08 3-11-08	1-02-00 2-01-08	23.49 14.67		
	2	C32 Jack-Open	6 /12	2-00-00	3-01-07	2 x 4	1-03-08 1-10-14	1-02-00 2-02-00	19.74 12.00		
	3	C33 Jack-Open	6 /12	1-10-14	2-01-07	2 x 4	1-03-08 1-02	1-02-00 2-01-07	21.98 14.00		

 TAMARACK ROOF TRUSSES INC. ALFA LUMBER GROUP		DELIVERY SHIPLIST			
		Lumber Yard: TAMARACK LUMBER		Job Track: 51225	
Builder: GREEN PARK HOMES		PlanLog: 202395			
Project: RUSSELL GARDENS PH.3		Layout ID: 408133			
Location: WATERDOWN		Ref #			
Model: MOUNTAINASH 3		Page: 3 of 3			
Lot #: 229		Date: 04-27-2020			
Elevation: 3- STD OR OPT.5 BR		Designer:			
		Sales Rep: Mario DiCano			

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	C34 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 1-11-09	1-02-00 2-01-08	18.92 12.00		
	1	C35 Jack-Open	6 /12	1-07-00	2-01-08	2 x 4		1-04-08 2-02-00	4.91 3.33		

TOTAL # TRUSS= 72 TOTAL BFT OF ALL TRUSSES= 2600.17 BFT. TOTAL WEIGHT OF ALL TRSSES 4119.53 LBS


HARDWARE

QTY	TYPE	MODEL	LENGTH
2	Hardware	HGUS26-2	
3	Hardware	LJS26DS	
12	Hardware	LUS24	
1	Hardware	LUS26-2	

TOTAL NUMBER OF
ITEMS= 18

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408131	T1	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 10:07:23 2020 Page 1
ID:DMCubINVR6TslFoe31v6l_zns1-q_awsdD8L4SQFGEKdu6MrxTwqWCorQSA0H0dzNDby

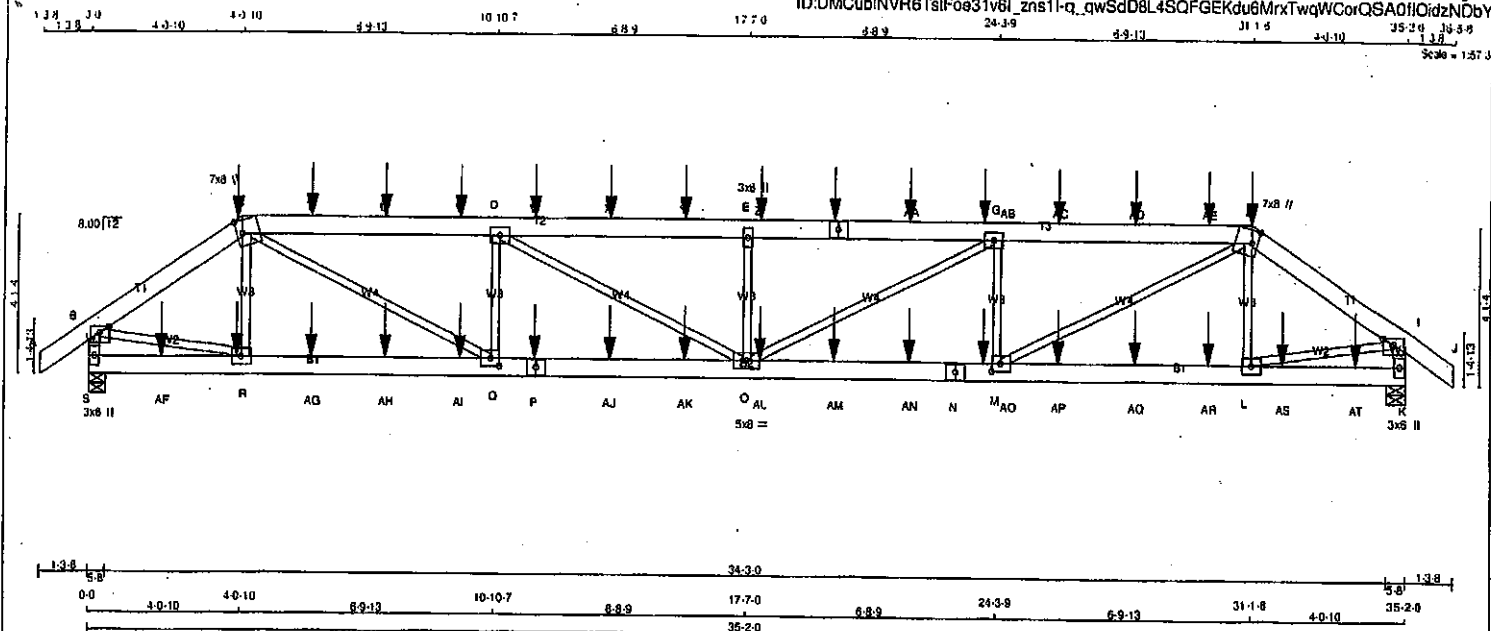

TOTAL WEIGHT = 2 X 180 = 359 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x6	DRY	No.2	SPF		
C - F	2x6	DRY	No.2	SPF		
F - H	2x6	DRY	No.2	SPF		
H - J	2x6	DRY	No.2	SPF		
S - B	2x4	DRY	No.2	SPF		
K - I	2x4	DRY	No.2	SPF		
S - P	2x6	DRY	No.2	SPF		
P - N	2x6	DRY	No.2	SPF		
N - K	2x6	DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 2	12	SIDE(122.0)
C - F 2	12	SIDE(81.0)
F - H 2	12	SIDE(122.0)
H - J 2	12	SIDE(122.0)
S - B 1	12	TOP
K - I 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S - P 2	12	SIDE(163.1)
P - N 2	12	SIDE(0.0)
N - K 2	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	BRG	UPLIFT	BRG	IN-SX
S	3397	0	3397	0	0	5-8	5-8	5-8	5-8
K	3346	0	3346	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST LOASE		MAX/MIN COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
S	2400	1588 / 0	0 / 0	0 / 0	0 / 0
K	2368	1557 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.02 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)	
CHORDS	MAX. FACTORED	FACTORED	MAX
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CS (LC)
FR-TO			
A-B	0 / 36	-91.8	-91.8 0.04 (1)
B-C	-4152 / 0	-91.8	-91.8 0.09 (1)
C-T	-8992 / 0	-91.8	-91.8 0.33 (1)
T-U	-8992 / 0	-91.8	-91.8 0.33 (1)
U-V	-8992 / 0	-91.8	-91.8 0.33 (1)
V-D	-8992 / 0	-91.8	-91.8 0.33 (1)
D-W	-7922 / 0	-91.8	-91.8 0.36 (1)
W-X	-7922 / 0	-91.8	-91.8 0.36 (1)
X-Y	-7922 / 0	-91.8	-91.8 0.36 (1)
Y-E	-7922 / 0	-91.8	-91.8 0.36 (1)
E-Z	-7922 / 0	-91.8	-91.8 0.36 (1)
Z-F	-7922 / 0	-91.8	-91.8 0.36 (1)
F-AA	-7922 / 0	-91.8	-91.8 0.36 (1)
AA-AB	-7922 / 0	-91.8	-91.8 0.36 (1)
AB-G	-7922 / 0	-91.8	-91.8 0.36 (1)
G-AC	-8885 / 0	-91.8	-91.8 0.33 (1)
AC-AD	-8885 / 0	-91.8	-91.8 0.33 (1)
AD-AE	-8885 / 0	-91.8	-91.8 0.33 (1)
AE-H	-8885 / 0	-91.8	-91.8 0.33 (1)
H-I	-4072 / 0	-91.8	-91.8 0.09 (1)
I-J	0 / 36	-91.8	-91.8 0.04 (1)
S-B	-3378 / 0	0.0	0.0 0.19 (1)
K-I	-3317 / 0	0.0	0.0 0.18 (1)

WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	MAX	CS (LC)
R-C	-518 / 0	0.06 (1)	0.06 (1)
C-Q	0 / 3920	0.49 (1)	0.49 (1)
Q-D	-1649 / 0	0.20 (1)	0.20 (1)
D-O	0 / 1172	0.15 (1)	0.15 (1)
O-E	-918 / 0	0.11 (1)	0.11 (1)
E-G	0 / 1203	0.15 (1)	0.15 (1)
M-G	-1670 / 0	0.20 (1)	0.20 (1)
M-H	0 / 3963	0.49 (1)	0.49 (1)
L-H	-501 / 0	0.08 (1)	0.08 (1)
B-R	0 / 3525	0.44 (1)	0.44 (1)
L-I	0 / 3457	0.43 (1)	0.43 (1)

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.20")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.38")

CSI: TC=0.38/1.00 (D-E:1), BC=0.52/1.00 (O-Q:1),
WB=0.49/1.00 (H-M:1), SSI=0.20/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (M) ; INPUT = 0.90 ;
JSI METAL = 0.63 (N) ; INPUT = 1.00 ;



Structural component only
DWG# T-2007017 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408131	T1	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:07:23 2020 Page 2

ID:DMCubINVR8TslFae31v6l zns1l-g qwSdD8L4SQFGEKdu6MrxTwqWCorQSA0lIQIdzNDBy

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW-m	MT20	7.0	8.0	4.00	1.75
D	TMWW-l	MT20	5.0	8.0		
E	TMW-w	MT20	3.0	8.0		
F	TS-l	MT20	5.0	8.0		
G	TMWW-l	MT20	5.0	8.0		
H	TTWW-m	MT20	7.0	8.0	4.00	1.75
I	TMVW-p	MT20	5.0	8.0	Edge	
K	BMV1-p	MT20	3.0	8.0		
L	BMWW-l	MT20	5.0	8.0		
M	BMWW-l	MT20	5.0	8.0	2.50	2.75
N	BS-l	MT20	5.0	8.0		
O	BMWW-l	MT20	5.0	8.0		
P	BS-l	MT20	5.0	8.0		
Q	BMWW-l	MT20	5.0	8.0	2.50	2.75
R	BMWW-l	MT20	5.0	8.0		
S	BMV1-p	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)


CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CS1 (LC)
FR-TO		FROM TO		FR-TO		FROM TO	
AR-L	0.3385	-18.5	-18.5	0.27 (1)	10.00		
LA-S	0.0	-18.5	-18.5	0.07 (4)	10.00		
AS-AT	0.0	-18.5	-18.5	0.07 (4)	10.00		
AT-K	0.0	-18.5	-18.5	0.07 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-10	-49	-55	---	FRONT	VERT	DEAD	---	C1
C	4-0-10	-117	-117	---	BACK	VERT	TOTAL	---	C1
C	4-0-10	-254	-254	---	FRONT	VERT	SNOW	---	C1
F	19-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
H	31-1-8	-49	-55	---	FRONT	VERT	DEAD	---	C1
H	31-1-8	-254	-254	---	FRONT	VERT	SNOW	---	C1
P	11-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
R	3-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
T	5-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	7-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	9-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	11-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
X	13-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
Y	15-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
Z	17-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AA	21-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AB	23-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AC	25-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AD	27-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AE	29-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AF	1-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AG	5-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AH	7-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AI	9-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AJ	13-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AK	15-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AL	17-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AM	19-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AN	21-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AO	23-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AP	25-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AQ	27-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AR	29-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AS	31-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AT	33-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

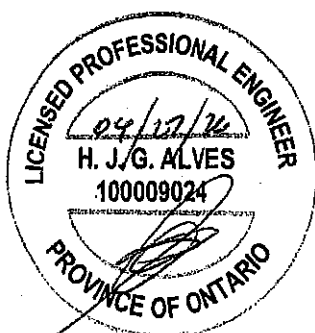


Structural component only
DWG# T-2007017

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408131	T1Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 10:07:24 2020 Page 1
ID:DMCubINVR6TstPoe31v6l_zns11-IAOJfzDm8NaHlQpWBbdbQ804PwSjap6JFJ2xE3zNDbX

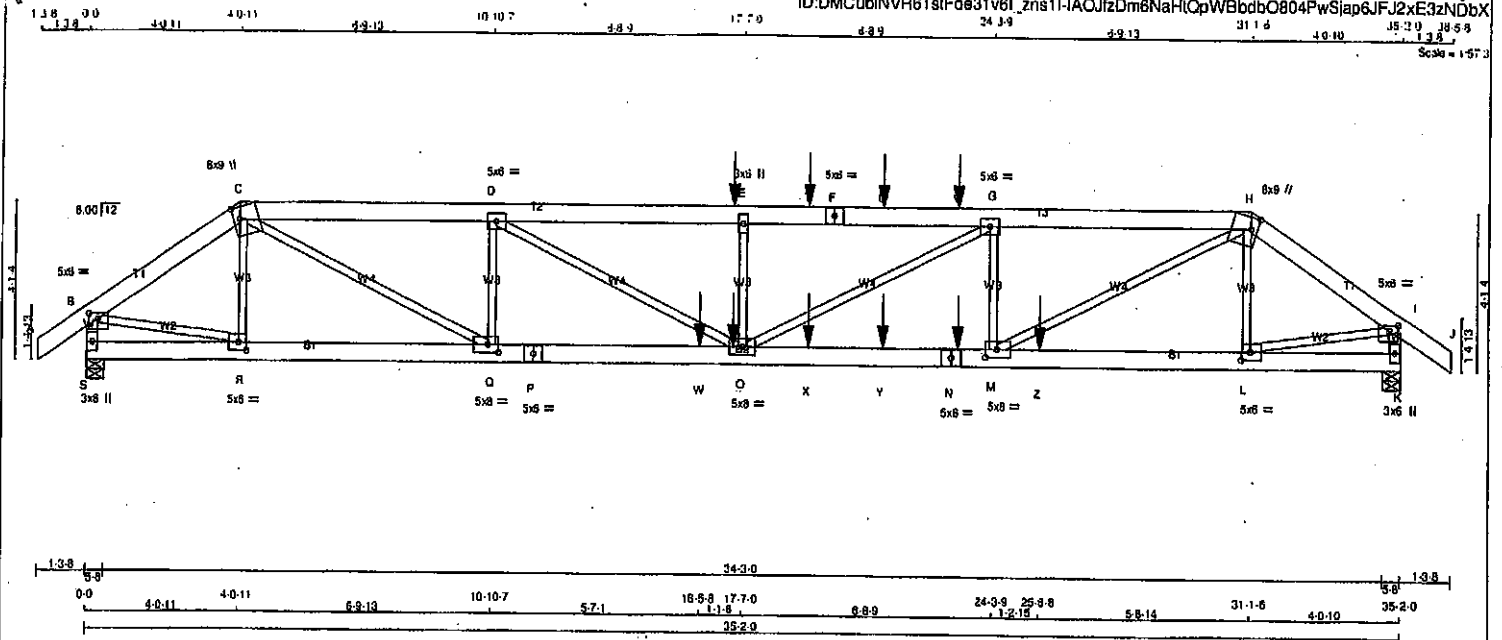

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x6 DRY No.2	SPF			
C - F	2x6 DRY No.2	SPF			
F - H	2x6 DRY No.2	SPF			
H - J	2x6 DRY No.2	SPF			
S - B	2x4 DRY No.2	SPF			
K - I	2x4 DRY No.2	SPF			
S - P	2x6 DRY No.2	SPF			
P - N	2x6 DRY No.2	SPF			
N - K	2x6 DRY No.2	SPF			

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C 2 12	TOP	
C-F 2 12	SIDE(183.1)	
F-H 2 12	SIDE(0.0)	
H-J 2 12	TOP	
S-B 1 12	TOP	
K-I 1 12	TOP	
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S-P 2 12	TOP	
P-N 2 12	SIDE(183.1)	
N-K 2 12	SIDE(0.0)	
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT VERT	3388 0	3388 0	5-8	5-8
S VERT	3900 0	3900 0	5-8	5-8

UNFACTORED REACTIONS

1ST LOASE	MAX./MIN. COMPONENT REACTIONS					
JT COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	2383	1588 / 0	0 / 0	0 / 0	805 / 0	0 / 0
K	2757	1818 / 0	0 / 0	0 / 0	939 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.48 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	W EBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)
FR-TO		FROM TO		FR-TO	
A-B	0 / 36	-91.8 -91.8 0.04 (1)	10.00	R-C	-859 / 0
B-C	-4130 / 0	-91.8 -91.8 0.09 (1)	5.53	Q-D	0 / 5288
C-D	-8076 / 0	-91.8 -91.8 0.29 (1)	4.07	Q-D	-2102 / 0
D-E	-10755 / 0	-91.8 -91.8 0.35 (1)	3.55	D-O	0 / 3048
E-T	-10755 / 0	-91.8 -91.8 0.44 (1)	3.46	O-E	-837 / 0
F-U	-10755 / 0	-91.8 -91.8 0.44 (1)	3.46	O-G	0 / 1721
F-U	-10755 / 0	-91.8 -91.8 0.44 (1)	3.46	M-G	-1681 / 0
U-V	-10755 / 0	-91.8 -91.8 0.44 (1)	3.46	M-H	0 / 5821
V-G	-10755 / 0	-91.8 -91.8 0.44 (1)	3.46	L-H	-436 / 0
G-H	-9242 / 0	-91.8 -91.8 0.33 (1)	3.81	B-R	0 / 3508
H-I	-4959 / 0	-91.8 -91.8 0.10 (1)	5.15	L-I	0 / 4210
I-J	0 / 36	-91.8 -91.8 0.04 (1)	10.00		
S-B	-3359 / 0	0.0 0.0 0.19 (1)	6.36		
K-I	-3970 / 0	0.0 0.0 0.22 (1)	5.94		

S-R	0 / 0	-18.5 -18.5 0.03 (4)	10.00
R-Q	0 / 3408	-18.5 -18.5 0.31 (1)	10.00
Q-P	0 / 8076	-18.5 -18.5 0.92 (1)	10.00
P-W	0 / 8076	-18.5 -18.5 0.92 (1)	10.00
W-O	0 / 8076	-18.5 -18.5 0.92 (1)	10.00
O-X	0 / 9242	-18.5 -18.5 0.74 (1)	10.00
X-Y	0 / 9242	-18.5 -18.5 0.74 (1)	10.00
Y-N	0 / 9242	-18.5 -18.5 0.74 (1)	10.00
N-M	0 / 9242	-18.5 -18.5 0.74 (1)	10.00
M-Z	0 / 4102	-18.5 -18.5 0.61 (1)	10.00
Z-L	0 / 4102	-18.5 -18.5 0.61 (1)	10.00
L-K	0 / 0	-18.5 -18.5 0.17 (1)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	17-4-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
N	23-4-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
O	17-4-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	19-4-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	21-4-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	23-4-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	16-5-8	-1480	-1480	---	FRONT	VERT	TOTAL	---	C1
X	19-4-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Y	21-4-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Z	25-8-8	-1144	-1144	---	FRONT	VERT	TOTAL	---	C1

TOTAL WEIGHT = 2 X 180 = 359 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 8.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, OBC 2012, ABC 2019
- PART 8 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. - G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = L/999 (0.30")
ALLOWABLE DEFL.(TL) = L/360 (1.17)
CALCULATED VERT. DEFL.(TL) = L/775 (0.54")

CSI: TC=0.44/1.00 (E-G:1), BC=0.92/1.00 (O-Q:1), WB=0.72/1.00 (H-M:1), SS=0.43/1.00 (O-Q:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1867	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (O) (INPUT = 0.90)

JSI METAL= 0.86 (N) (INPUT = 1.00)

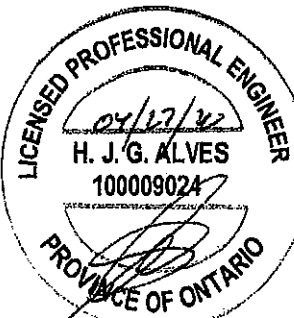

Structural component only
DWG# T-2007018 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408131	T1Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:07:24 2020 Page 2
ID:DMCubINVR6TstFge31v6l zns11-IAQJfzDm6NaHkQpWBbdbQ804PwSjap6JFJ2xE3zNObX

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	5.0	8.0	1.75	2.75
C	TTWW+m	MT20	8.0	9.0	3.75	2.00
D	TMWW-l	MT20	5.0	8.0		
E	TMWW-w	MT20	3.0	8.0		
F	TS-l	MT20	5.0	8.0		
G	TMWW-l	MT20	5.0	8.0		
H	TTWW+m	MT20	8.0	9.0	3.75	2.00
I	TMWW-p	MT20	5.0	8.0	1.75	2.75
K	BMV1+p	MT20	3.0	8.0		
L	BMWW-l	MT20	5.0	8.0	2.50	2.75
M	BMWW-l	MT20	5.0	8.0	2.50	3.50
N	BS-l	MT20	5.0	8.0		
O	BMWW-l	MT20	5.0	8.0		
P	BS-l	MT20	5.0	8.0		
Q	BMWW-l	MT20	5.0	8.0	2.50	3.50
R	BMWW-l	MT20	5.0	8.0	2.50	2.75
S	BMV1+p	MT20	3.0	8.0		

CONNECTION REQUIREMENTS

- 1) CT: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007018 3/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408132	T1 Z2	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitel Industries, Inc. Sat Apr 26 10:24:28 2020 Page 1
ID:DMCubINVR6TstFoe31v6f_zns11-Nn9g9QbqQOLGUUxx3EzGoILk8uFo14TkGjC0GqzNDLZ

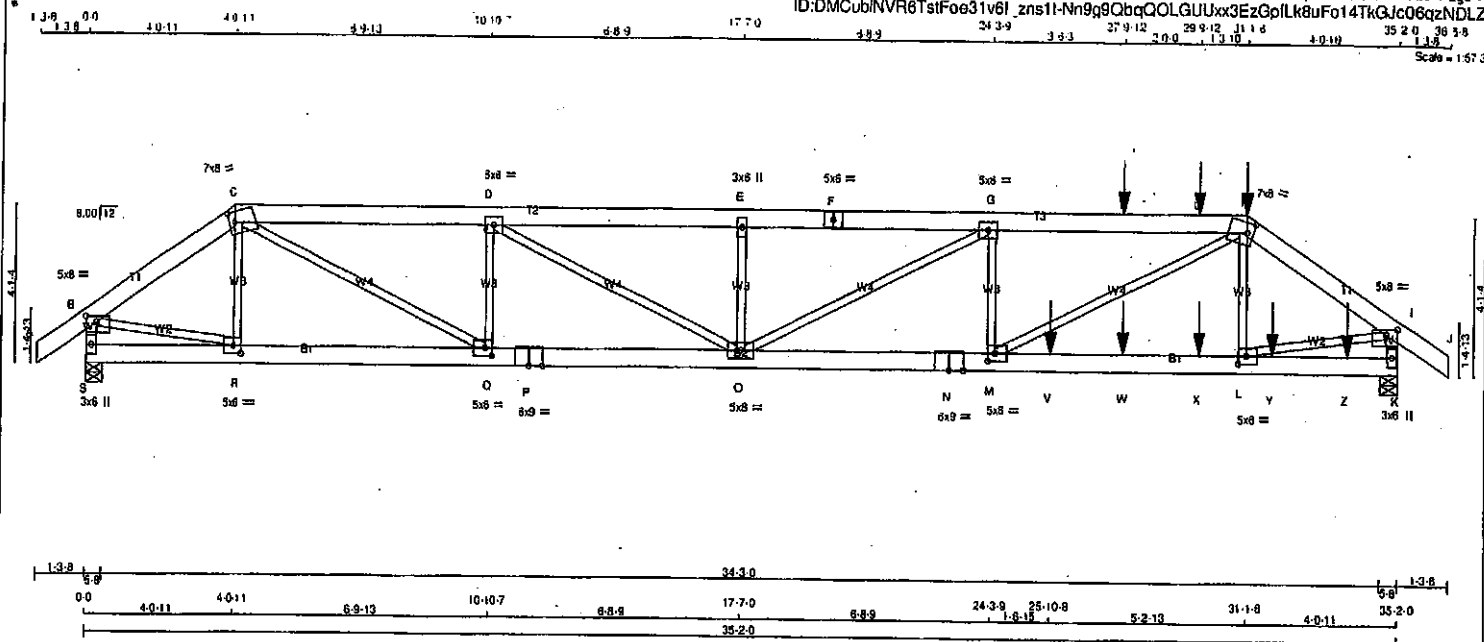

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x6	DRY	No.2	SPF		
C - F	2x6	DRY	No.2	SPF		
F - H	2x6	DRY	No.2	SPF		
H - J	2x6	DRY	No.2	SPF		
S - B	2x4	DRY	No.2	SPF		
K - I	2x4	DRY	No.2	SPF		
S - P	2x6	DRY	No.2	SPF		
P - N	2x6	DRY	No.2	SPF		
N - K	2x6	DRY	No.2	SPF		
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 2	12	TOP
C - F 2	12	TOP
F - H 2	12	SIDE(81.0)
H - J 2	12	SIDE(122.0)
S - B 1	12	TOP
K - I 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S - P 2	12	TOP
P - N 2	12	TOP
N - K 2	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
S	2892	0	2892	0
K	4101	0	4101	0

UNFACTORED REACTIONS	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM.LIVE	
S	1900	1271/0	0/0	0/0	629/0
K	2893	1938/0	0/0	0/0	955/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.87 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC.	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO		LENGTH	FR-TO			
A-B	0 / 36	-91.8	-91.8	0.04 (1)	10.00	R-C	-442 / 0	0.05 (1)
B-C	-3201 / 0	-91.8	-91.8	0.08 (1)	6.10	C-Q	0 / 3750	0.46 (1)
C-D	-5955 / 0	-91.8	-91.8	0.22 (1)	4.69	Q-D	-1603 / 0	0.19 (1)
D-E	-7669 / 0	-91.8	-91.8	0.25 (1)	4.19	D-O	0 / 1951	0.24 (1)
E-F	-7669 / 0	-91.8	-91.8	0.25 (1)	4.20	O-E	-575 / 0	0.07 (1)
F-G	-7669 / 0	-91.8	-91.8	0.25 (1)	4.20	O-G	-915 / 0	0.53 (1)
G-T	-8473 / 0	-91.8	-91.8	0.40 (1)	3.87	M-G	-301 / 2	0.04 (1)
T-U	-8473 / 0	-91.8	-91.8	0.40 (1)	3.87	M-H	0 / 4612	0.57 (1)
U-H	-8473 / 0	-91.8	-91.8	0.40 (1)	3.87	L-H	-128.99	0.02 (4)
H-I	-5308 / 0	-91.8	-91.8	0.11 (1)	5.00	B-R	0 / 2717	0.34 (1)
I-J	0 / 36	-91.8	-91.8	0.04 (1)	10.00	L-I	0 / 4508	0.56 (1)
S-B	-2875 / 0	0.0	0.0	0.15 (1)	6.97			
K-I	-4227 / 0	0.0	0.0	0.23 (1)	5.78			
S-R	0 / 0	-18.5	-18.5	0.04 (4)	10.00			
R-Q	0 / 2644	-18.5	-18.5	0.20 (1)	10.00			
Q-P	0 / 5955	-18.5	-18.5	0.48 (1)	10.00			
P-O	0 / 5955	-18.5	-18.5	0.48 (1)	10.00			
O-N	0 / 8473	-18.5	-18.5	0.86 (1)	10.00			
N-M	0 / 8473	-18.5	-18.5	0.86 (1)	10.00			
M-V	0 / 4401	-18.5	-18.5	0.92 (1)	10.00			
V-W	0 / 4401	-18.5	-18.5	0.92 (1)	10.00			
W-X	0 / 4401	-18.5	-18.5	0.92 (1)	10.00			
X-L	0 / 4401	-18.5	-18.5	0.92 (1)	10.00			
L-Y	0 / 0	-18.5	-18.5	0.29 (1)	10.00			
Y-Z	0 / 0	-18.5	-18.5	0.29 (1)	10.00			
Z-K	0 / 0	-18.5	-18.5	0.29 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
JT	31-1-8	-49	-55	---	FRONT	VERT	DEAD	---	C1
H	31-1-8	-254	-254	---	FRONT	VERT	SNOW	---	C1
T	27-9-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	29-9-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	25-10-5	-2027	-2027	---	FRONT	VERT	TOTAL	---	C1
W	27-9-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
X	29-9-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Y	31-9-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Z	33-9-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 180 = 359 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADOT USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = L/999 (0.22)
ALLOWABLE DEFL.(TL) = L/360 (1.17)
CALCULATED VERT. DEFL.(TL) = L/999 (0.40)

CSI: TC=0.40/1.00 (G-H:1), BC=0.92/1.00 (L-M:1), WB=0.57/1.00 (H-M:1), SS=0.54/1.00 (L-M:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (C) INPUT = 0.90
JSI METAL = 0.81 (P) INPUT = 1.00

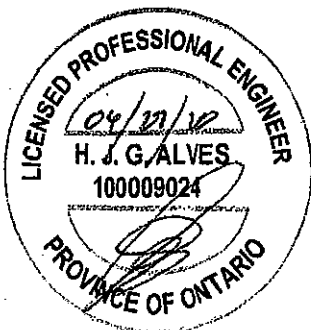

Structural component only
DWG# T-2007029 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408132	T1Z2	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 10:24:26 2020 Page 2


ID:DMCubINVR6TstFoe31v6I zns1I-Nn9a8QbaQOLGUUxx3EzGpfLk8uFo14TkGlc06qzNOLZ

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.75	3.50
C	TTWW-m	MT20	7.0	8.0	3.25	2.00
D	TMVW-t	MT20	5.0	6.0		
E	TMVW-w	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMVW-t	MT20	5.0	6.0		
H	TTWW-m	MT20	7.0	8.0	3.25	2.00
I	TMVW-p	MT20	5.0	8.0	1.75	3.50
K	BMV1-p	MT20	3.0	6.0		
L	BMVW-t	MT20	5.0	6.0	2.50	2.50
M	BMVW-t	MT20	5.0	6.0	2.50	2.25
N	BS-t	MT20	8.0	9.0		
O	BMVWW-t	MT20	5.0	8.0		
P	BS-t	MT20	6.0	9.0		
Q	BMVW-t	MT20	5.0	6.0	2.50	2.25
R	BMVW-t	MT20	5.0	6.0	2.50	2.50
S	BMV1-p	MT20	3.0	6.0		

CONNECTION REQUIREMENTS


- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

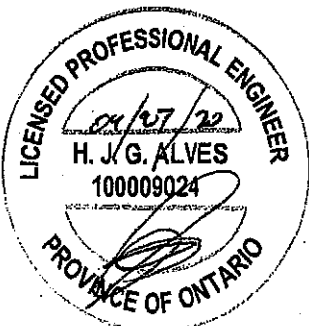

Structural component only
DWG# T-2007029

JOB NAME: 408087 TRUSS NAME: T2 QUANTITY: 2 PLY: 1 JOB DESC: GREEN PARK HOMES TRUSS DESC: Tamarack Roof Truss, Burlington

Version 8.310 9 Oct 29 2019 MITek Industries, Inc. Sat Apr 25 08:33:16 2020 Page 1
ID:DMCUBINVR8TstF0e31v6I_zns11-XSdn720dKAPeSmfdrQX69arNwQSPC0cRZZ7bzNEH1
Scale = 1:57.0

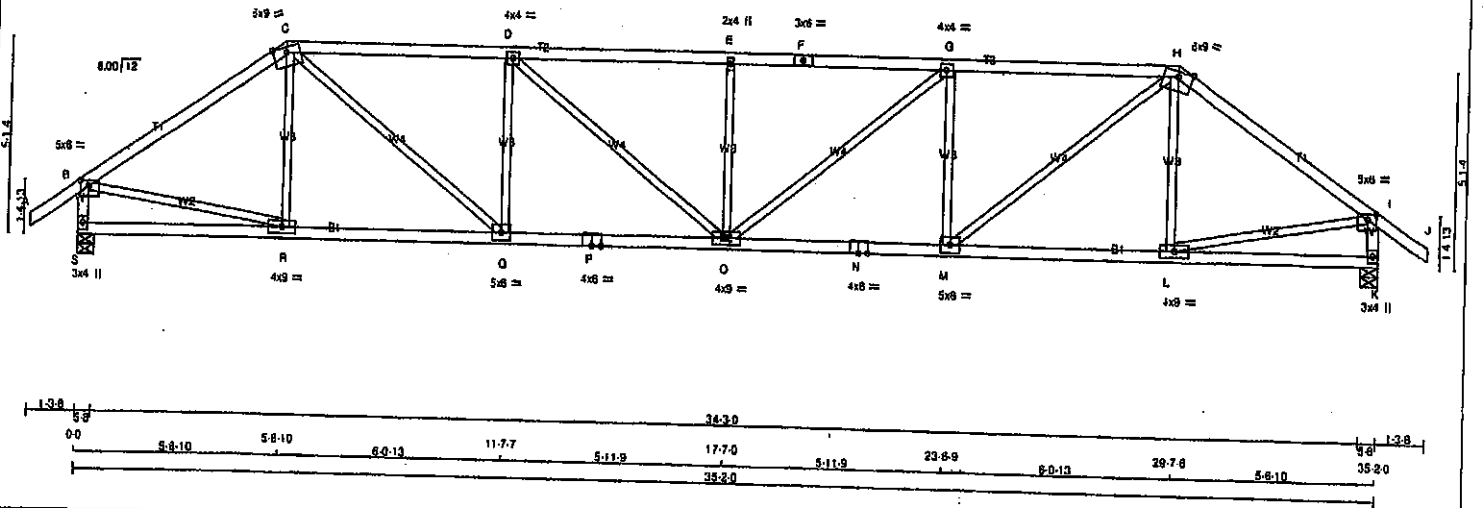

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR
A - C	2x4	DRY	No.2		SPF
C - F	2x4	DRY	No.2		SPF
F - H	2x4	DRY	No.2		SPF
H - J	2x4	DRY	No.2		SPF
J - L	2x4	DRY	No.2		SPF
L - N	2x4	DRY	No.2		SPF
N - K	2x4	DRY	No.2		SPF
ALL WEBS		2x3	DRY	No.2	SPF
EXCEPT					
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75	
C	TTWW-m	MT20	6.0	9.0	Edge		
D	TMWW-i	MT20	4.0	4.0			
E	TMWW-w	MT20	2.0	4.0			
F	TS-t	MT20	3.0	6.0			
G	TMWW-i	MT20	4.0	4.0			
H	TTWW-m	MT20	6.0	9.0	Edge		
I	TMVW-p	MT20	5.0	6.0	1.75	2.75	
K	BMV1-p	MT20	3.0	4.0			
L	BMWW-i	MT20	4.0	9.0			
M	BMWW-i	MT20	5.0	6.0			
N	BS-t	MT20	4.0	6.0			
O	BMWW-w	MT20	4.0	9.0			
P	BS-t	MT20	4.0	6.0			
Q	BMWW-i	MT20	5.0	6.0			
R	BMWW-i	MT20	4.0	9.0			
S	BMV1-p	MT20	3.0	4.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
JT	VERT	DOWN	IN-SX	BRG
S	2085	0	0	5-8
K	2085	0	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	0 / 0
K	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED	MAX
MEMB.	FORCE (LBS)	VERT. (PLF)	CS1 (LC)	UNBRAC	LENGTH	FR-TO	MEMB.	FORCE (LBS)	MAX
FR-TO									
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	R-C	-243 / 10	0.09 (1)	
B-C	-2297 / 0	-91.8	-91.8	0.70 (1)	3.78	C-Q	0 / 1670	0.38 (1)	
C-D	-3214 / 0	-91.8	-91.8	0.80 (1)	3.18	D-O	-829 / 0	0.38 (1)	
D-E	-3595 / 0	-91.8	-91.8	0.88 (1)	2.97	O-D	0 / 480	0.11 (1)	
E-F	-3595 / 0	-91.8	-91.8	0.88 (1)	2.97	O-E	-505 / 0	0.19 (1)	
F-G	-3595 / 0	-91.8	-91.8	0.88 (1)	2.97	O-G	0 / 490	0.11 (1)	
G-H	-3214 / 0	-91.8	-91.8	0.80 (1)	3.18	M-G	-929 / 0	0.38 (1)	
H-I	-2297 / 0	-91.8	-91.8	0.70 (1)	3.78	M-H	0 / 1870	0.38 (1)	
I-J	0 / 35	-91.8	-91.8	0.12 (1)	10.00	L-H	-243 / 10	0.09 (1)	
S-S	-2023 / 0	0.0	0.0	0.21 (1)	5.94	B-R	0 / 1943	0.44 (1)	
K-I	-2023 / 0	0.0	0.0	0.21 (1)	5.94	L-I	0 / 1943	0.44 (1)	
S-R	0 / 0	-18.5	-18.5	0.15 (4)	10.00				
R-Q	0 / 1904	-18.5	-18.5	0.39 (1)	10.00				
Q-P	0 / 3214	-18.5	-18.5	0.58 (1)	10.00				
P-O	0 / 3214	-18.5	-18.5	0.58 (1)	10.00				
O-N	0 / 3214	-18.5	-18.5	0.58 (1)	10.00				
N-M	0 / 3214	-18.5	-18.5	0.58 (1)	10.00				
M-L	0 / 1904	-18.5	-18.5	0.39 (1)	10.00				
L-K	0 / 0	-18.5	-18.5	0.15 (4)	10.00				

TOTAL WEIGHT = 2 X 140 = 280 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
OL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 8 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CS1 TC=0.88/1.00 (E-G:1), BC=0.98/1.00 (D-Q:1), WB=0.44/1.00 (B-R:1), SS=0.26/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (B) (INPUT = 0.80)
JSI METAL = 0.74 (P) (INPUT = 1.00)

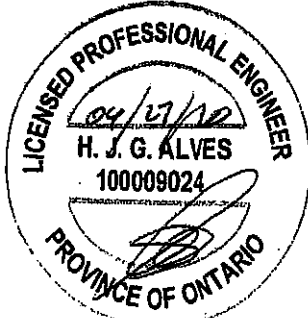

JOB NAME 408087	TRUSS NAME T3	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 08:53:16 2020 Page 1
ID:DMCubINVR6TstFos31v6l_zns1-XSdn72OldKAPesmfRqX89aw0vGsP37cRIZZ7tzNEh1
Scale = 1:57.3

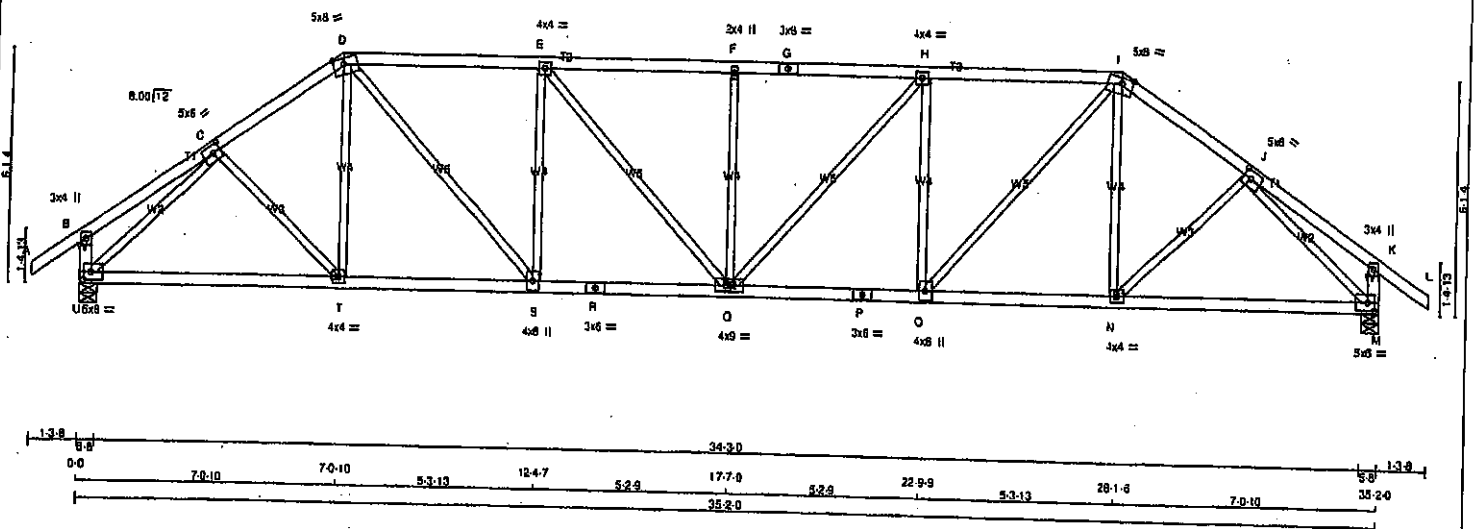

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
U - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV-p	MT20	3.0	4.0
C	TMVW-1	MT20	5.0	8.0 2.50 2.50
D	TTWV-m	MT20	5.0	8.0 1.75 3.50
E	TMVW-1	MT20	4.0	4.0
F	TMVW-w	MT20	2.0	4.0
G	TS-1	MT20	3.0	6.0
H	TMVW-1	MT20	4.0	4.0
I	TTWV-m	MT20	5.0	8.0 1.75 3.50
J	TMVW-1	MT20	5.0	8.0 2.50 2.50
K	TMV-p	MT20	3.0	4.0
M	BMVW-1	MT20	5.0	8.0 2.50 2.25
N	BMVW-1	MT20	4.0	4.0
O	BMVW-1	MT20	4.0	6.0
P	BS-1	MT20	3.0	6.0
Q	BMVW-1	MT20	4.0	9.0
R	BS-1	MT20	3.0	6.0
S	BMVW-1	MT20	4.0	6.0
T	BMVW-1	MT20	4.0	4.0
U	BMVW-1	MT20	5.0	8.0 2.50 2.25

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORIZ	DOWN	HORIZ	UPLIFT	IN-SX	IN-SX
U	2085	0	2085	0	0	5-8	5-8
M	2085	0	2085	0	0	5-8	5-8

UNFACTORED REACTIONS		1ST LOASE		MAX/MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERMLIVE	WIND
U	1458	970 / 0	0 / 0	0 / 0	488 / 0
M	1458	970 / 0	0 / 0	0 / 0	488 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.53 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO			
A-B	0 / 35	-01.8	-01.8 0.12 (1)	10.00	C-T	0 / 135	0.03 (4)
B-C	0 / 18	-01.8	-01.8 0.18 (1)	10.00	T-D	0 / 90	0.03 (4)
C-D	-2306 / 0	-01.8	-01.8 0.23 (1)	4.31	D-S	0 / 1218	0.27 (1)
D-E	-2724 / 0	-01.8	-01.8 0.54 (1)	3.69	S-E	-814 / 0	0.48 (1)
E-F	-2967 / 0	-01.8	-01.8 0.56 (1)	3.53	E-Q	0 / 363	0.08 (1)
F-G	-2967 / 0	-01.8	-01.8 0.56 (1)	3.53	Q-F	-440 / 0	0.28 (1)
G-H	-2967 / 0	-01.8	-01.8 0.56 (1)	3.53	H-Q	0 / 363	0.08 (1)
H-I	-2724 / 0	-01.8	-01.8 0.54 (1)	3.69	I-H	-814 / 0	0.48 (1)
I-J	-2306 / 0	-01.8	-01.8 0.23 (1)	4.31	J-I	0 / 1218	0.27 (1)
J-K	0 / 18	-01.8	-01.8 0.18 (1)	10.00	K-I	0 / 90	0.03 (4)
K-L	0 / 35	-01.8	-01.8 0.12 (1)	10.00	N-J	0 / 135	0.03 (4)
U-B	-255 / 0	0.0	0.0 0.03 (1)	7.81	U-C	-2515 / 0	0.97 (1)
M-K	-255 / 0	0.0	0.0 0.03 (1)	7.81	J-M	-2515 / 0	0.97 (1)
U-T	0 / 1802	-18.5	-18.5 0.40 (1)	10.00			
T-S	0 / 1901	-18.5	-18.5 0.41 (1)	10.00			
S-R	0 / 2724	-18.5	-18.5 0.49 (1)	10.00			
R-Q	0 / 2724	-18.5	-18.5 0.49 (1)	10.00			
Q-P	0 / 2724	-18.5	-18.5 0.49 (1)	10.00			
P-O	0 / 2724	-18.5	-18.5 0.49 (1)	10.00			
O-N	0 / 1901	-18.5	-18.5 0.41 (1)	10.00			
N-M	0 / 1802	-18.5	-18.5 0.40 (1)	10.00			

TOTAL WEIGHT = 2 X 161 = 303 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.18")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.29")

CSI: TC=0.58/1.00 (E-F:1), BC=0.49/1.00 (Q-S:1), WB=0.97/1.00 (C-U:1), SSI=0.23/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 384 1887 788 1987 1888


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (U) (INPUT = 0.90)
JSI METAL = 0.84 (P) (INPUT = 1.00)



Structural component only
DWG# T-2006955

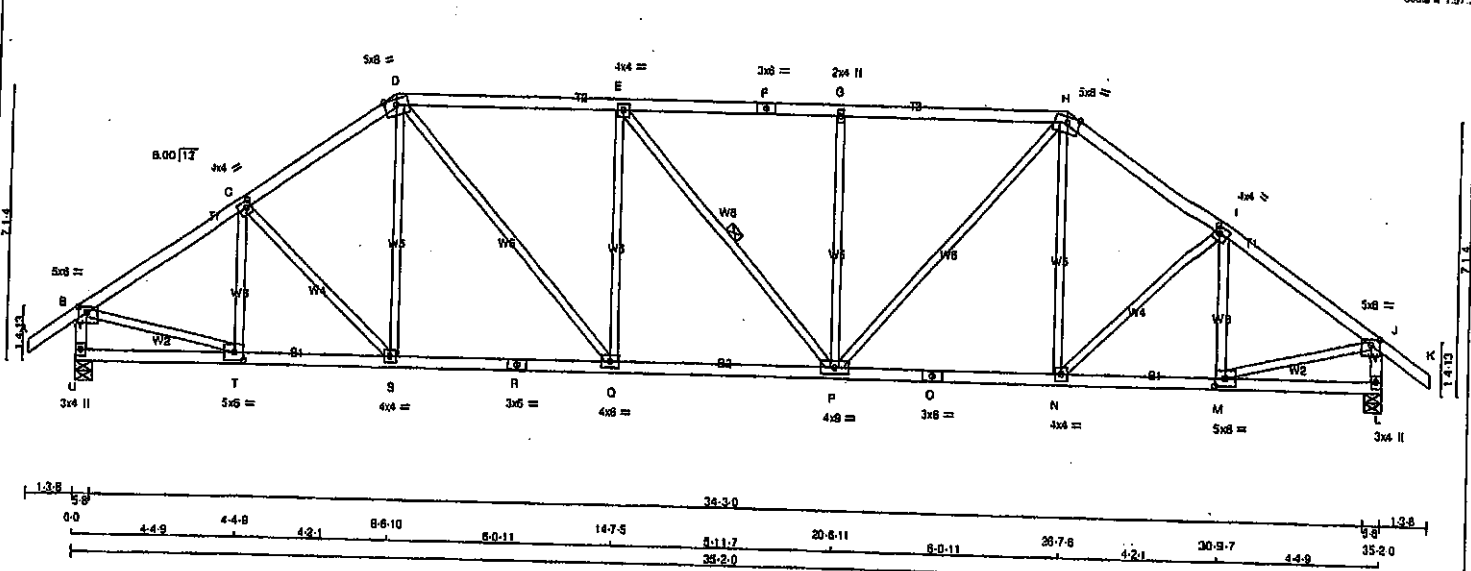

LUMBER
 N. L. G. A. RULES
 CHORDS SIZE LUMBER

A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
U - J	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75 2.75
C	TMVW-w	MT20	4.0	4.0	2.00 1.50
D	TTVW-m	MT20	5.0	8.0	Edge
E	TMVW-i	MT20	4.0	4.0	
F	TS-i	MT20	3.0	8.0	
G	TMVW-w	MT20	2.0	4.0	
H	TTVW-m	MT20	5.0	8.0	Edge
I	TMVW-i	MT20	4.0	4.0	2.00 1.50
J	TMVW-p	MT20	5.0	8.0	1.75 2.75
L	BMV1-p	MT20	3.0	4.0	
M	BMVW-i	MT20	5.0	8.0	2.50 2.75
N	BMVW-i	MT20	4.0	4.0	
O	BS-i	MT20	3.0	8.0	
P	BMVW-i	MT20	4.0	9.0	
Q	BMVW-i	MT20	4.0	8.0	
R	BS-i	MT20	3.0	6.0	
S	BMVW-i	MT20	4.0	4.0	
T	TMVW-i	MT20	5.0	8.0	2.50 2.75
U	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	UP		
U	2085	0	2085	0	5-8	5-8
L	2085	0	2085	0	5-8	5-8

UNFACTORED REACTIONS

JT	MAX/MIN COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
U	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PL)	MAX. OSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. OSI (LC)	
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	T-C	-396 / 0	0.11 (1)
B-C	-2270 / 0	-91.8	-91.8 0.37 (1)	4.19	C-S	-79 / 0	0.05 (1)
C-D	-2254 / 0	-91.8	-91.8 0.38 (1)	4.21	S-D	0 / 156	0.04 (4)
D-E	-2485 / 0	-91.8	-91.8 0.84 (1)	3.72	D-Q	0 / 949	0.21 (1)
E-F	-2484 / 0	-91.8	-91.8 0.84 (1)	3.72	Q-E	-597 / 0	0.52 (1)
F-G	-2484 / 0	-91.8	-91.8 0.84 (1)	3.72	E-P	-2 / 0	0.00 (1)
G-H	-2484 / 0	-91.8	-91.8 0.84 (1)	3.74	P-G	-597 / 0	0.52 (1)
H-I	-2254 / 0	-91.8	-91.8 0.38 (1)	4.21	P-H	0 / 947	0.21 (1)
I-J	-2270 / 0	-91.8	-91.8 0.37 (1)	4.19	H-N	0 / 157	0.04 (4)
J-K	0 / 35	-91.8	-91.8 0.12 (1)	10.00	N-I	-78 / 0	0.05 (1)
U-B	-2027 / 0	0.0	0.0 0.21 (1)	5.94	M-I	-397 / 0	0.11 (1)
L-J	-2028 / 0	0.0	0.0 0.21 (1)	5.94	B-T	0 / 1968	0.44 (1)
					M-J	0 / 1968	0.44 (1)
U-T	0 / 0	-18.5	-18.5 0.08 (4)	10.00			
T-S	0 / 1909	-18.5	-18.5 0.37 (1)	10.00			
S-R	0 / 1854	-18.5	-18.5 0.38 (1)	10.00			
R-Q	0 / 1854	-18.5	-18.5 0.38 (1)	10.00			
Q-P	0 / 2485	-18.5	-18.5 0.47 (1)	10.00			
P-O	0 / 1854	-18.5	-18.5 0.36 (1)	10.00			
O-N	0 / 1854	-18.5	-18.5 0.38 (1)	10.00			
N-M	0 / 1909	-18.5	-18.5 0.37 (1)	10.00			
M-L	0 / 0	-18.5	-18.5 0.08 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 OL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 OL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.64/1.00 (D-E:1), BC=0.47/1.00 (P-Q:1), WB=0.52/1.00 (E-Q:1), SB=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1687 788 1987 1686

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.90 (D) (INPUT = 0.90)
 JSI METAL = 0.82 (D) (INPUT = 1.00)

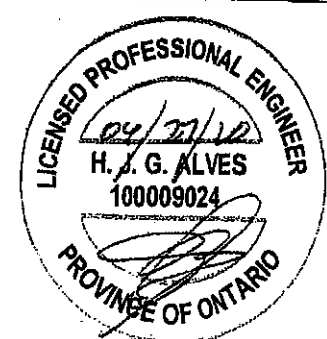

Structural component only
 DWG# T.2006066

JOB NAME 408087	TRUSS NAME T5	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 08:53:18 2020 Page 1	

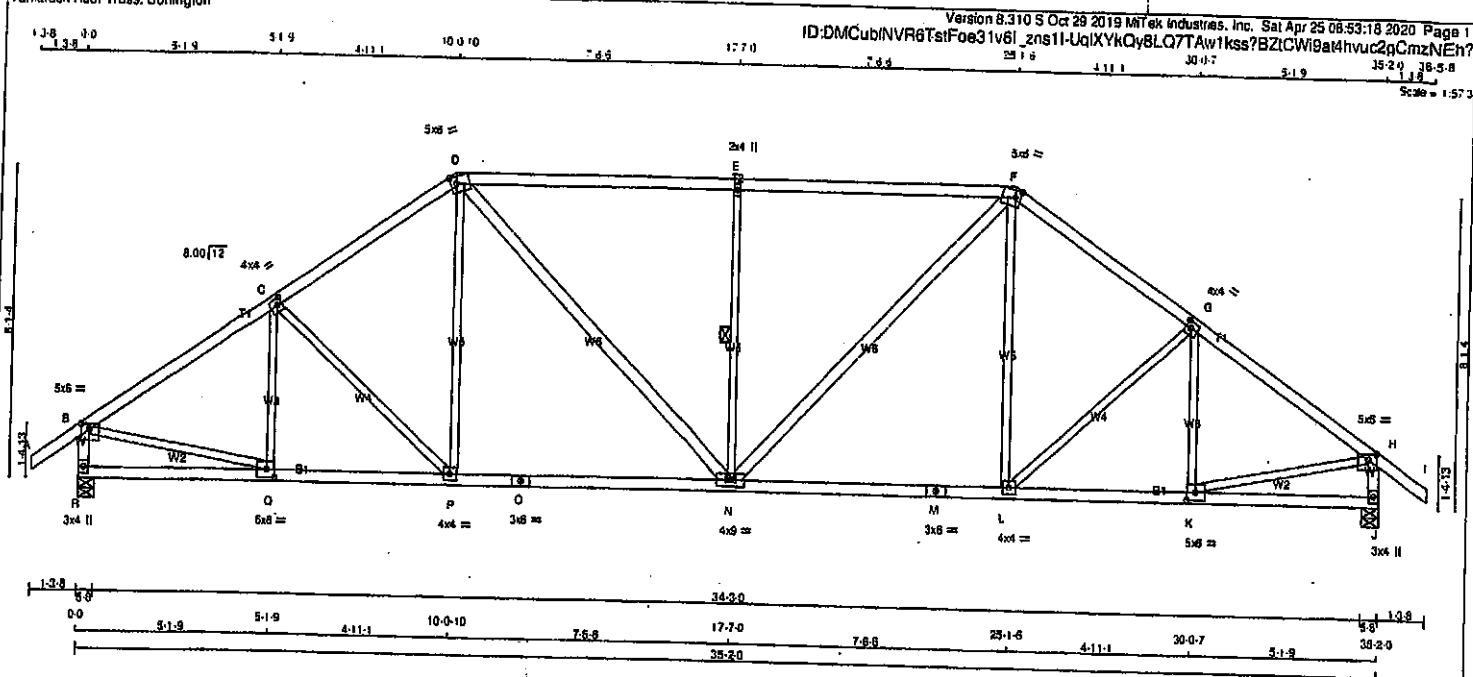

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
R - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
R - O	2x4	DRY	No.2	SPF
O - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
D - N	2x4	DRY	No.2	SPF
N - F	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TTVW-m	MT20	5.0	6.0	2.25	1.75
E	TMVW-w	MT20	2.0	4.0		
F	TTVW-m	MT20	5.0	6.0	2.25	1.75
G	TMVW-t	MT20	4.0	4.0	2.00	1.50
H	TMVW-p	MT20	5.0	6.0	1.75	2.75
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-t	MT20	5.0	6.0	2.50	2.75
L	BMVW-t	MT20	4.0	4.0		
M	BS-t	MT20	3.0	6.0		
N	BMVW-w	MT20	4.0	9.0		
O	BS-t	MT20	3.0	6.0		
P	BMVW-t	MT20	4.0	4.0		
Q	BMVW-t	MT20	5.0	6.0	2.50	2.75
R	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	UPLIFT		
R	2065	0	2065	0	5-8	5-8
J	2065	0	2065	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LOASE COMBINED		MAX/MIN. COMPONENT REACTIONS				
	SNOW	LIVE	PERM	LIVE	WIND	DEAD	SOIL
R	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
J	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		MAX. UNBRACED LENGTH	MEMB.	WEBS	
	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PLF)	FROM	TO			MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
R-TO	0 / 35					Q-C	-321 / 0	0.11 (1)
A-B		-91.8	-91.8	0.12 (1)	10.00	C-P	-218 / 0	0.18 (1)
B-C	-2318 / 0	-91.8	-91.8	0.38 (1)	4.18	P-D	0 / 268	0.08 (1)
C-D	-2188 / 0	-91.8	-91.8	0.37 (1)	4.28	D-N	0 / 692	0.11 (1)
D-E	-2275 / 0	-91.8	-91.8	0.51 (1)	3.47	N-E	-851 / 0	0.35 (1)
E-F	-2275 / 0	-91.8	-91.8	0.51 (1)	3.47	N-F	0 / 692	0.11 (1)
F-G	-2188 / 0	-91.8	-91.8	0.37 (1)	4.28	L-F	0 / 268	0.08 (1)
G-H	-2318 / 0	-91.8	-91.8	0.38 (1)	4.18	L-G	-218 / 0	0.18 (1)
H-I	0 / 35	-91.8	-91.8	0.12 (1)	10.00	K-G	-321 / 0	0.11 (1)
R-B	-2022 / 0	0.0	0.0	0.21 (1)	5.94	B-Q	0 / 1996	0.45 (1)
J-H	-2022 / 0	0.0	0.0	0.21 (1)	5.94	K-H	0 / 1996	0.45 (1)
R-Q	0 / 0	-18.5	-18.5	0.10 (4)	10.00			
Q-P	0 / 1953	-18.5	-18.5	0.40 (1)	10.00			
P-O	0 / 1794	-18.5	-18.5	0.41 (1)	10.00			
O-N	0 / 1794	-18.5	-18.5	0.41 (1)	10.00			
N-M	0 / 1794	-18.5	-18.5	0.41 (1)	10.00			
M-L	0 / 1794	-18.5	-18.5	0.41 (1)	10.00			
L-K	0 / 1953	-18.5	-18.5	0.40 (1)	10.00			
K-J	0 / 0	-18.5	-18.5	0.10 (4)	10.00			

TOTAL WEIGHT = 2 X 158 = 317 lb (M/F)

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = L/999 (0.11)
ALLOWABLE DEFL.(TL) = L/360 (1.17)
CALCULATED VERT. DEFL.(TL) = L/999 (0.22)

CSI: TC=0.81/1.00 (D-E:1), SC=0.41/1.00 (N-P:1), WB=0.45/1.00 (B-Q:1), SS=0.34/1.00 (D-E:1)


DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PLJ)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1867 788 1987 1656
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (B) (INPUT = 0.90)
JSI METAL = 0.57 (O) (INPUT = 1.00)

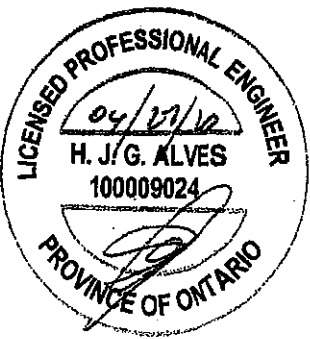


Structural component only
DIM/C# T 0006057

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408087	T6	2	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 08:53:19 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-y1Jw4RavfYz5KVEIZOEknORi6V7cXt27GoDKCzNEh

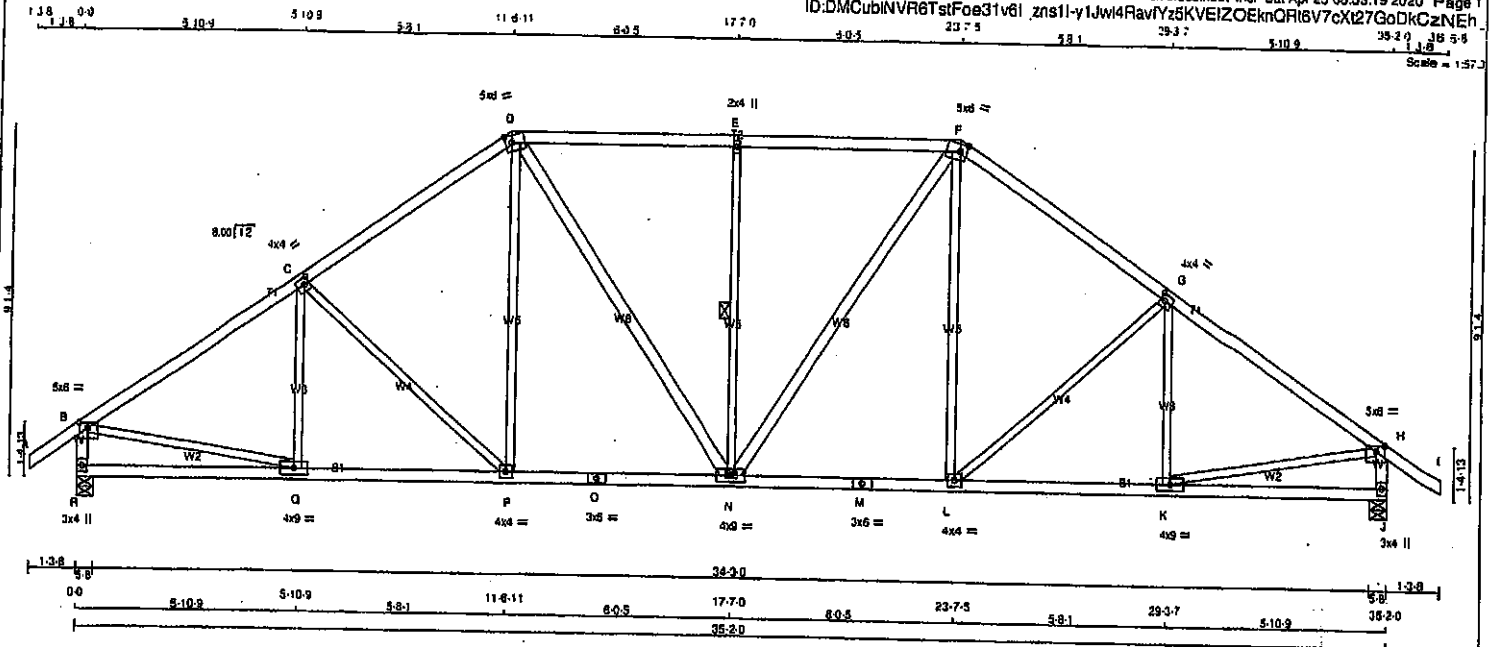

LUMBER			
N.L.G.A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
J - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
	FACTORED	MAXIMUM FACTORED	INPUT	REQD					
	GROSS REACTION	GROSS REACTION	BRG	BRG					
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
R	2065	0	2065	0	0	5-8	5-8		
J	2065	0	2065	0	0	5-8	5-8		
UNFACTORED REACTIONS									
	1ST LCASE	MAX/MIN	COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM	LIVE	WIND	DEAD	SOIL	
R	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	488 / 0	0 / 0	
J	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	488 / 0	0 / 0	

TOTAL WEIGHT = 2 X 165 = 329 lb

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y
B	TMVW-p	MT20	5.0	6.0	1.75
C	TMVW-t	MT20	4.0	4.0	2.00
D	TTWW-m	MT20	5.0	6.0	2.25
E	TMVW-w	MT20	2.0	4.0	
F	TTWW-m	MT20	6.0	8.0	2.25
G	TMVW-t	MT20	4.0	4.0	2.00
H	TMVW-p	MT20	6.0	6.0	1.75
J	BMV1-p	MT20	3.0	4.0	
K	BMVW-t	MT20	4.0	9.0	
L	BMVW-t	MT20	4.0	4.0	
M	BS-t	MT20	3.0	6.0	
N	BMVW-w	MT20	4.0	9.0	
O	BS-t	MT20	3.0	6.0	
P	BMVW-t	MT20	4.0	4.0	
Q	BMVW-t	MT20	4.0	9.0	
R	BMV1-p	MT20	3.0	4.0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	Q-C	-248 / 11	0.11 (1)
B-C	-2347 / 0	-91.8	-91.8 0.52 (1)	3.99	C-P	-358 / 0	0.42 (1)
C-D	-2098 / 0	-91.8	-91.8 0.48 (1)	4.22	P-D	0 / 342	0.08 (1)
D-E	-1985 / 0	-91.8	-91.8 0.49 (1)	4.26	D-N	0 / 477	0.08 (1)
E-F	-1985 / 0	-91.8	-91.8 0.49 (1)	4.26	N-E	-877 / 0	0.37 (1)
F-G	-2098 / 0	-91.8	-91.8 0.48 (1)	4.22	N-F	0 / 477	0.08 (1)
G-H	-2347 / 0	-91.8	-91.8 0.52 (1)	3.99	L-F	0 / 342	0.08 (1)
H-I	0 / 35	-91.8	-91.8 0.12 (1)	10.00	L-G	-358 / 0	0.42 (1)
R-B	-2018 / 0	0.0	0.0 0.21 (1)	5.94	K-G	-248 / 11	0.11 (1)
J-H	-2018 / 0	0.0	0.0 0.21 (1)	5.94	B-Q	0 / 2014	0.45 (1)
					K-H	0 / 2014	0.45 (1)
R-Q	0 / 0	-18.5	-18.5 0.14 (4)	10.00			
Q-P	0 / 1981	-18.5	-18.5 0.39 (1)	10.00			
P-O	0 / 1716	-18.5	-18.5 0.34 (1)	10.00			
O-N	0 / 1716	-18.5	-18.5 0.34 (1)	10.00			
N-M	0 / 1716	-18.5	-18.5 0.34 (1)	10.00			
M-L	0 / 1716	-18.5	-18.5 0.34 (1)	10.00			
L-K	0 / 1981	-18.5	-18.5 0.39 (1)	10.00			
K-J	0 / 0	-18.5	-18.5 0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = L/999 (0.10)
ALLOWABLE DEFL.(TL) = L/360 (1.17)
CALCULATED VERT. DEFL.(TL) = L/999 (0.19)

CSI: TC=0.52/1.00 (B-C:1), BC=0.39/1.00 (K-L:1), WB=0.45/1.00 (H-K:1), SS=0.27/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(OR)Y SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (B) (INPUT = 0.90)

JSI METAL= 0.56 (M) (INPUT = 1.00)

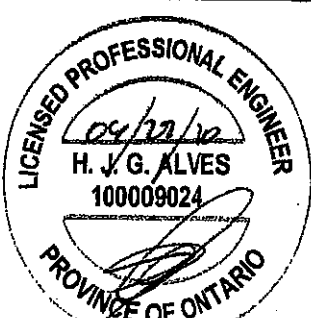

Structural component only



BEARINGS							
FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG		
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
T	2065	0	2065	0	0	5-8	5-8
L	2065	0	2065	0	0	5-8	5-8

UNFACTORED REACTIONS							
1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
T	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF

BOT CH. LL = 0.0 PSF
DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-Q, F-P, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED VERT. LOAD (L1) (PLF)	MAX CSI (LC)	MAX. UNBRACED LENGTH	MAX. FACTORED		MAX CSI (LC)
MEMB.	FORCE (LBS)				MEMB.	FORCE (LBS)	
FR-TO		FROM TO			FR-TO		
A-B	0 / 35	-91.8 -91.8	0.12 (1)	10.00	S-C	-189 / 46	0.10 (1)
B-C	-2359 / 0	-91.8 -91.8	0.89 (1)	3.77	C-Q	-485 / 0	0.24 (1)
C-D	-1995 / 0	-91.8 -91.8	0.82 (1)	4.11	Q-E	0 / 416	0.09 (1)
D-E	-1986 / 0	-91.8 -91.8	0.82 (1)	4.11	E-P	0 / 315	0.05 (1)
E-F	-1762 / 0	-91.8 -91.8	0.27 (1)	4.77	P-F	-502 / 0	0.35 (1)
F-G	-1762 / 0	-91.8 -91.8	0.27 (1)	4.77	P-G	0 / 315	0.05 (1)
G-H	-1986 / 0	-91.8 -91.8					

- PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 20 14
 (55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN
 LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF
 LIVE LOAD
 ALLOWABLE DEFL. (LL) = $L/360$ (1.17")
 CALCULATED VERT. DEFL. (LL) = $L/999$ (0.09")
 ALLOWABLE DEFL. (TL) = $L/360$ (1.17")
 CALCULATED VERT. DEFL. (TL) = $L/999$ (0.18")
 CSk: $T_C = 0.89/1.00$ (I-J:1), $B_C = 0.42/1.00$ (M-O:1),
 $W_B = 0.45/1.00$ (J-M:1), $S_S = 0.24/1.00$ (J-I:1)
 DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10
 COMPANION LIVE LOAD FACTOR = 1.00

H-I	-1986 / 0	-91.8	-91.8	0.02 (1)	4.11	C-G	0 / 416	0.09 (1)
I-J	-2359 / 0	-91.8	-91.8	0.02 (1)	4.11	O-I	-485 / 0	0.24 (1)
J-K	0 / 35	-91.8	-91.8	0.69 (1)	3.77	M-I	-189 / 46	0.10 (1)
T-B	-2014 / 0	0.0	0.0	0.12 (1)	10.00	B-S	0 / 2022	0.45 (1)
L-J	-2014 / 0	0.0	0.0	0.21 (1)	5.95	M-J	0 / 2022	0.45 (1)
T-S	0 / 0	-18.5	-18.5	0.19 (4)	10.00			
S-R	0 / 1986	-18.5	-18.5	0.42 (1)	10.00			
R-Q	0 / 1986	-18.5	-18.5	0.42 (1)	10.00			
Q-P	0 / 1630	-18.5	-18.5	0.32 (1)	10.00			
P-O	0 / 1830	-18.5	-18.5	0.32 (1)	10.00			
O-N	0 / 1996	-18.5	-18.5	0.42 (1)	10.00			
N-M	0 / 1996	-18.5	-18.5	0.42 (1)	10.00			
M-L	0 / 0	-18.5	-18.5	0.19 (4)	10.00			


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1657 788	1987 1666

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408131	T8	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 10:07:25 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns1l-rmMyhUJOth8UaOj18qwmZ83KuJJKWSUznUmVzNDbW

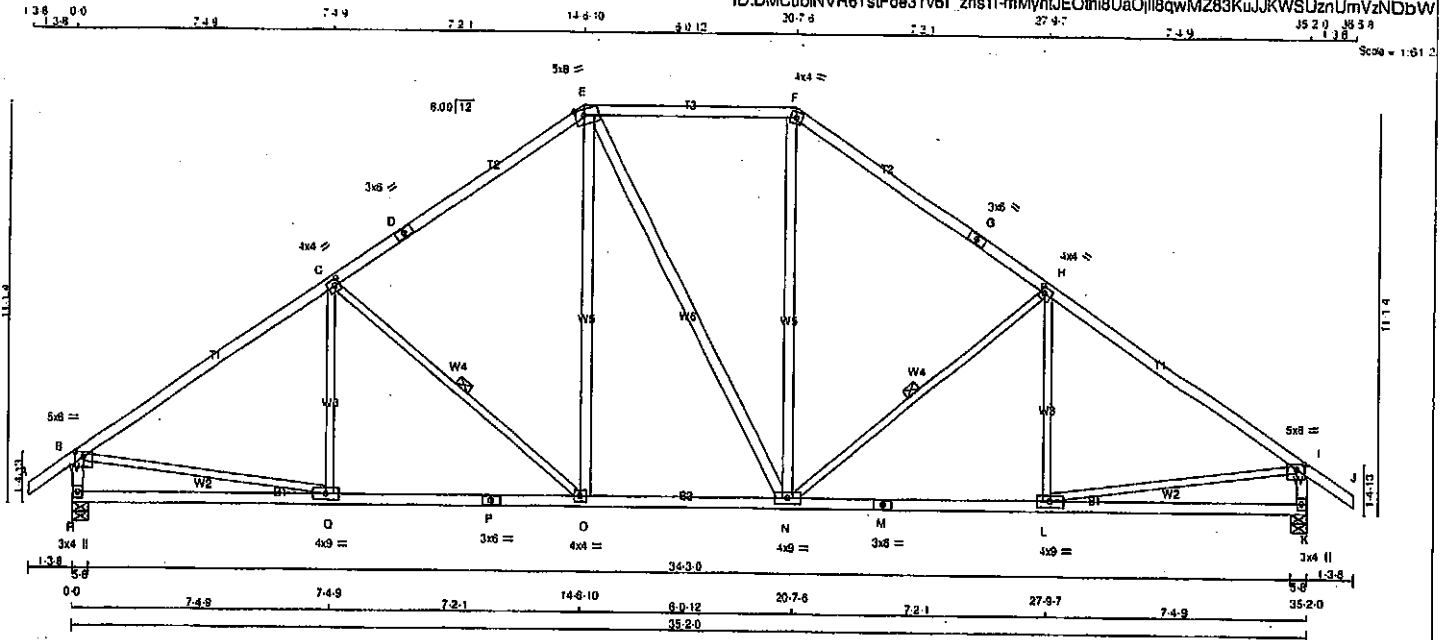

TOTAL WEIGHT = 2 X 168 = 333 lb
[M/F]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
R - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2
M - K	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
O - E	2x4	DRY	No.2
E - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (Nails in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	6.0	1.75 2.75
C	TMVW-l	MT20	4.0	4.0	2.00 1.50
D	TS-t	MT20	3.0	6.0	
E	TTVW-m	MT20	5.0	6.0	2.00 3.00
F	TTW-m	MT20	4.0	4.0	
G	TS-t	MT20	3.0	6.0	
H	TMVW-l	MT20	4.0	4.0	2.00 1.50
I	TMVW-p	MT20	5.0	6.0	1.75 2.75
K	BMV1-p	MT20	3.0	4.0	
L	BMVW-l	MT20	4.0	9.0	
M	BS-l	MT20	3.0	6.0	
N	BMVWVW-l	MT20	4.0	9.0	
O	BMVWV-l	MT20	4.0	4.0	
P	BS-l	MT20	3.0	6.0	
Q	BMVW-l	MT20	4.0	9.0	
R	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		RECORD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
R	2085	0	2085	0	0	5-8	5-8	5-8	5-8
K	2085	0	2085	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST LCASE		MAX./MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
R	1458	970.0	0.0	0.0	0.0
K	1458	970.0	0.0	0.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.45 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM	TO	LENGTH	FR-TO		
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	O-C	-139 / 78	0.09 (1)
B-C	-2358 / 0	-91.8	-91.8 0.89 (1)	3.45	C-O	-605 / 0	0.38 (1)
C-D	-1888 / 0	-91.8	-91.8 0.78 (1)	3.91	O-E	0 / 499	0.08 (1)
D-E	-1888 / 0	-91.8	-91.8 0.78 (1)	3.91	E-N	0 / 0	0.00 (1)
E-F	-1538 / 0	-91.8	-91.8 0.47 (1)	4.74	N-F	0 / 500	0.08 (1)
F-G	-1888 / 0	-91.8	-91.8 0.78 (1)	3.91	N-H	-604 / 0	0.38 (1)
G-H	-1888 / 0	-91.8	-91.8 0.78 (1)	3.91	L-H	-140 / 75	0.09 (1)
H-I	-2357 / 0	-91.8	-91.8 0.89 (1)	3.45	B-Q	0 / 2020	0.45 (1)
I-J	0 / 35	-91.8	-91.8 0.12 (1)	10.00	L-I	0 / 2020	0.45 (1)
R-B	-2009 / 0	0.0	0.0 0.21 (1)	5.95			
K-I	-2009 / 0	0.0	0.0 0.21 (1)	5.95			
R-Q	0 / 0	-18.5	-18.5 0.25 (4)	10.00			
Q-P	0 / 1999	-18.5	-18.5 0.45 (1)	10.00			
P-O	0 / 1999	-18.5	-18.5 0.45 (1)	10.00			
O-N	0 / 1538	-18.5	-18.5 0.33 (1)	10.00			
N-M	0 / 1999	-18.5	-18.5 0.45 (1)	10.00			
M-L	0 / 1999	-18.5	-18.5 0.45 (1)	10.00			
L-K	0 / 0	-18.5	-18.5 0.24 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, CBC 2012, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CSI: TC=0.89/1.00 (B-C:1), BC=0.45/1.00 (O-Q:1), WB=0.45/1.00 (B-Q:1), SS=0.27/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1856


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (F) (INPUT = 0.90)
JSI METAL = 0.88 (P) (INPUT = 1.00)

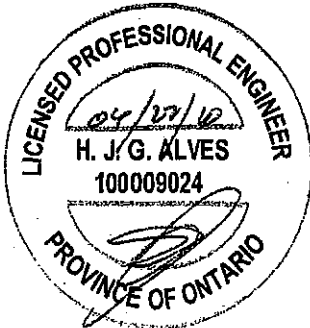

Structural component only
DWG# T-2007019

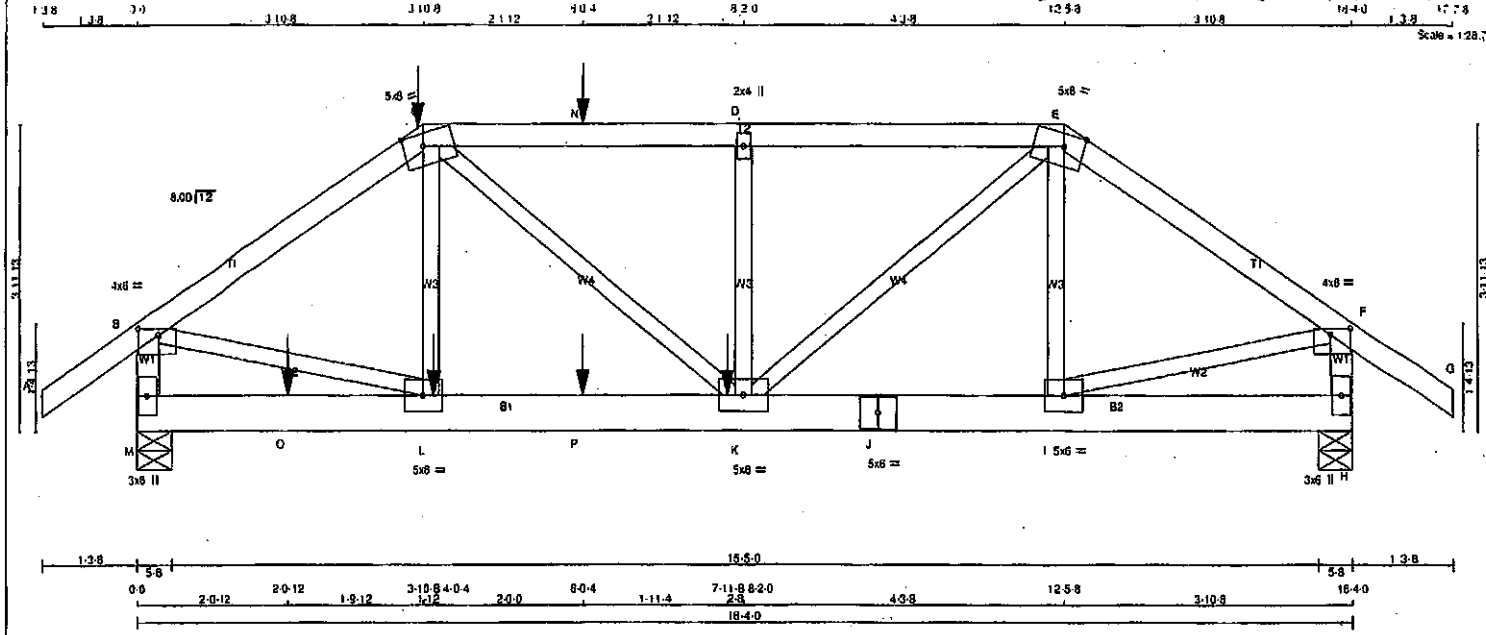

TOTAL WEIGHT = 78 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	QESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
M - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
M - J	2x6	DRY	No.2
J - H	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY, SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
GT	VERT	GROSS REACTION	GROSS REACTION	GROSS REACTION	GROSS REACTION	BRG	BRG	BRG	BRG
M	1679	0	1679	0	0	5-8	5-8	5-8	5-8
H	1496	0	1496	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST CASE		MAX./MIN. COMPONENT REACTIONS		2ND CASE		3RD CASE		4TH CASE	
GT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	GT	COMBINED
M	1183	803/0	0/0	0/0	0/0	380/0	0/0	M	1183
H	1053	717/0	0/0	0/0	0/0	338/0	0/0	H	1053

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.17 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED (LBS)	MAX CSI (LC)	
FR-TO		FROM	TO		FR-TO			
A-B	0/35	-91.8	-91.8	0.14 (1)	10.00	L-C	-216/28	0.05 (1)
B-C	-1751/0	-91.8	-91.8	0.33 (1)	4.66	C-K	0/874	0.22 (1)
C-N	-2118/0	-91.8	-91.8	0.42 (1)	4.17	K-D	-523/0	0.13 (1)
N-D	-2118/0	-91.8	-91.8	0.42 (1)	4.17	K-E	0/1120	0.28 (1)
D-E	-2118/0	-91.8	-91.8	0.42 (1)	4.17	I-E	-203/0	0.05 (1)
E-F	-1523/0	-91.8	-91.8	0.31 (1)	4.94	B-L	0/1499	0.37 (1)
F-G	0/35	-91.8	-91.8	0.14 (1)	10.00	I-F	0/1304	0.32 (1)
M-B	-1643/0	0.0	0.0	0.18 (1)	8.42			
H-F	-1469/0	0.0	0.0	0.16 (1)	6.71			
M-O	0/0	-18.5	-18.5	0.05 (4)	10.00			
O-L	0/0	-18.5	-18.5	0.05 (4)	10.00			
L-P	0/1448	-18.5	-18.5	0.26 (1)	10.00			
P-K	0/1448	-18.5	-18.5	0.28 (1)	10.00			
K-J	0/1259	-18.5	-18.5	0.23 (1)	10.00			
J-I	0/1259	-18.5	-18.5	0.23 (1)	10.00			
I-H	0/0	-18.5	-18.5	0.04 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

GT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	3-10-8	-255	-255		FRONT	VERT	TOTAL		C1
K	7-11-8	-729	-729		FRONT	VERT	TOTAL		C1
L	4-0-4	-17	-17		FRONT	VERT	TOTAL		C1
N	6-0-4	-86	-86		FRONT	VERT	TOTAL		C1
O	2-0-12	-17	-17		FRONT	VERT	TOTAL		C1
P	6-0-4	-17	-17		FRONT	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL = 8.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2010, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-08, CSA 086-14
 - TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
 CALCULATED VERT. DEFL.(LL) = U/999 (0.05")
 ALLOWABLE DEFL.(TL) = L/360 (0.54")
 CALCULATED VERT. DEFL.(TL) = U/999 (0.08")

CSI: TC=0.42/1.00 (C-D:1), BC=0.28/1.00 (K-L:1),
 WB=0.37/1.00 (B-L:1), SSI=0.25/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (E) (INPUT = 0.90)
 JSI METAL = 0.40 (F) (INPUT = 1.00)



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408131	T10	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:07:27 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-j4RI?GfPlyskuY5sBI0neb0714nJ2xHGbrOzNDbU

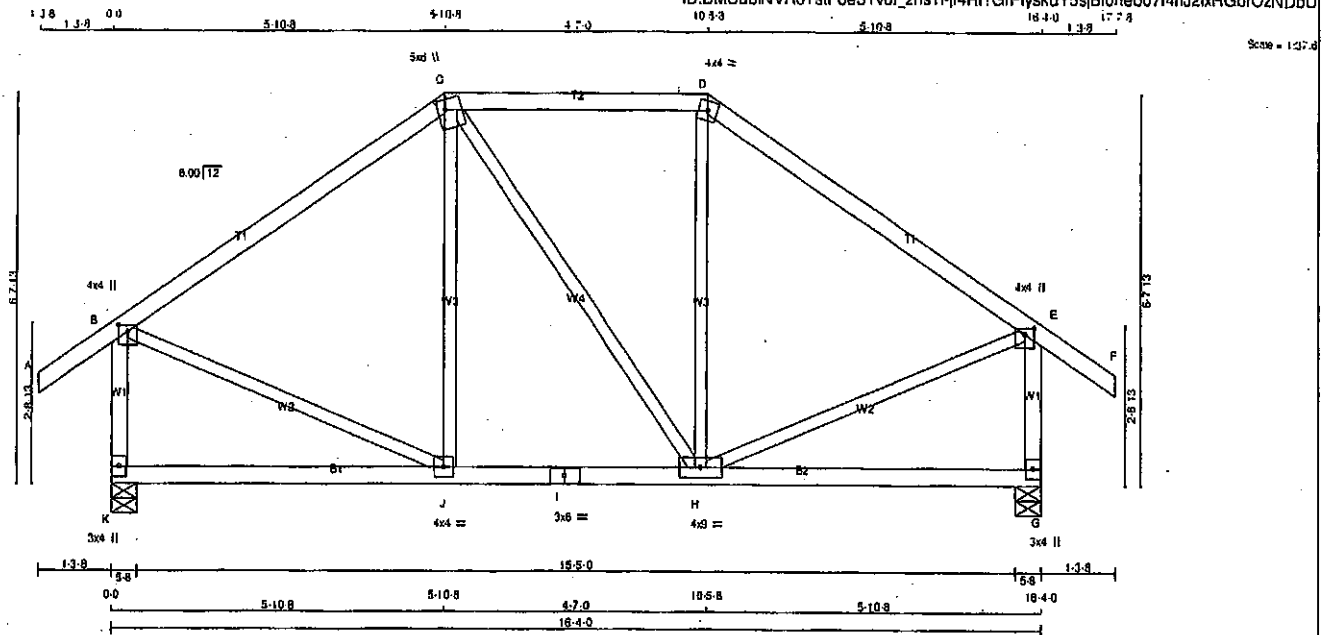

TOTAL WEIGHT = 2 X 75 = 150 lb (M/F)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF		
C - D	2x4 DRY	No.2	SPF		
D - F	2x4 DRY	No.2	SPF		
K - B	2x4 DRY	No.2	SPF		
G - E	2x4 DRY	No.2	SPF		
K - I	2x4 DRY	No.2	SPF		
I - G	2x4 DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW+P	MT20	4.0	4.0	1.25	2.00
C	TTWW+m	MT20	5.0	6.0	2.00	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMWW+P	MT20	4.0	4.0	1.25	2.00
G	BMV1+P	MT20	3.0	4.0		
H	BMWW+I	MT20	4.0	9.0		
I	BS-I	MT20	3.0	6.0		
J	BMWW-I	MT20	4.0	4.0		
K	BMV1+P	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
		GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
K	1028	0	1028	0	0	5-8	5-8		
G	1028	0	1028	0	0	5-8	5-8		

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	723	488/0	0/0	0/0	0/0	235/0	0/0
G	723	488/0	0/0	0/0	0/0	235/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	UNBRACED LENGTH (FT)
FR-TO				FR-TO			
A-B	0/35	-91.8	-91.8 0.12 (1)	10.00	J-C	-115/40	0.08 (1)
B-C	-655/0	-91.8	-91.8 0.41 (1)	8.25	C-H	0/0	0.00 (1)
C-D	-542/0	-91.8	-91.8 0.25 (1)	6.25	H-D	-116/40	0.08 (1)
D-E	-655/0	-91.8	-91.8 0.41 (1)	8.25	B-J	0/587	0.13 (1)
E-F	0/35	-91.8	-91.8 0.12 (1)	10.00	H-E	0/587	0.13 (1)
K-B	-980/0	0.0	0.0 0.14 (1)	7.81			
G-E	-979/0	0.0	0.0 0.14 (1)	7.81			
K-J	0/0	-18.5	-18.5 0.14 (4)	10.00			
J-I	0/543	-18.5	-18.5 0.17 (4)	10.00			
I-H	0/543	-18.5	-18.5 0.17 (4)	10.00			
H-G	0/0	-18.5	-18.5 0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TO=0.41/1.00 (B-C:1), BC=0.17/1.00 (H-J:4), WB=0.13/1.00 (B-J:1), SSI=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1667 788 1997 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.69 (8) (INPUT = 0.90)
JSI METAL = 0.21 (8) (INPUT = 1.00)




Structural component only
DWG# T-2007021

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408131	T11	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 10:07:28 2020 Page 1
ID:DMCubNVR6TsiFae31v6l_zns11-BxepVLGHAc4IL27IQRIXY_BpKX?MWeGvAx09NqzND6T

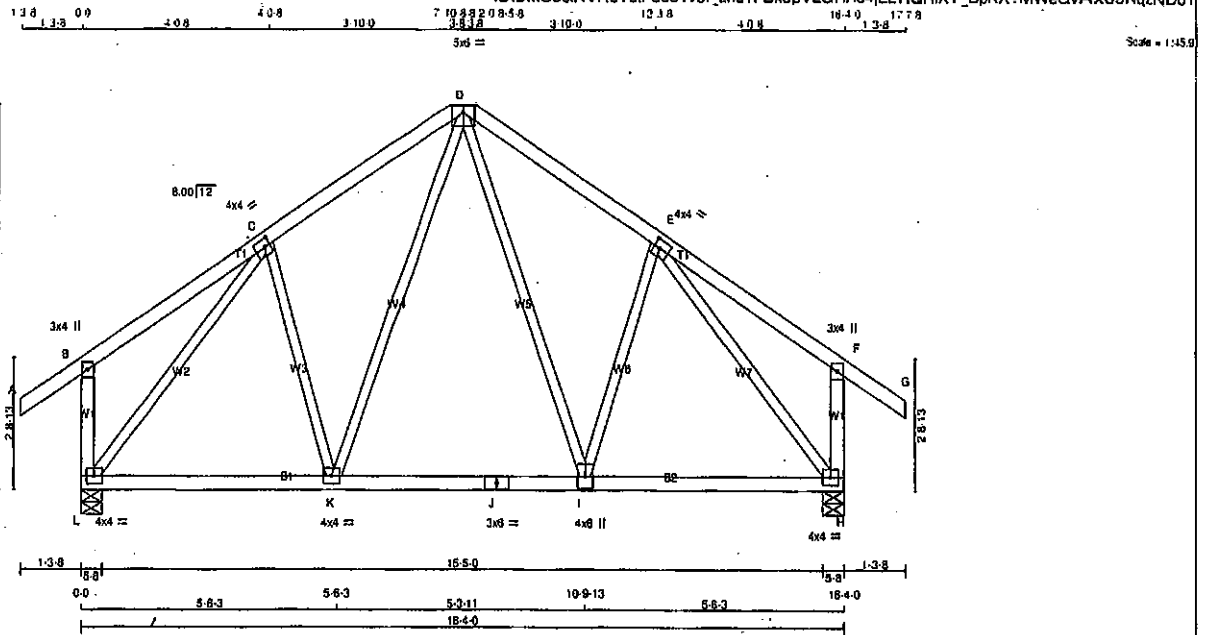

TOTAL WEIGHT = 2 X 81 = 162 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - G	2x4	DRY	No.2	SPF		
L - B	2x4	DRY	No.2	SPF		
H - F	2x4	DRY	No.2	SPF		
L - J	2x4	DRY	No.2	SPF		
J - H	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-1	MT20	4.0	4.0	2.00	1.50
D	TMTMWm	MT20	5.0	6.0	1.50	3.00
E	TMWW-1	MT20	4.0	4.0	2.00	1.50
F	TMV+p	MT20	3.0	4.0		
H	BMVW-1	MT20	4.0	4.0		
I	BMVW-1	MT20	4.0	6.0		
J	BS-1	MT20	3.0	6.0		
K	BMVW-1	MT20	4.0	4.0		
L	BMVW-1	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORIZ	BRG	IN-SX	BRG	IN-SX
L	1028	0	1028	0	0	5-8	5-8		
H	1028	0	1028	0	0	5-8	5-8		

UNFACTORED REACTIONS

JT	COMBINED	1ST LOASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	723	488 / 0	0 / 0	0 / 0	0 / 0	0 / 0	235 / 0	0 / 0
H	723	488 / 0	0 / 0	0 / 0	0 / 0	0 / 0	235 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED (LC1)	MEMB.	FORCE (LBS)	MAX. FACTORED (LC)	
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	C-K	-105 / 24	0.05 (1)	
B-C	0 / 25	-91.8	-91.8 0.25 (1)	K-D	0 / 222	0.05 (1)	
C-D	-671 / 0	-91.8	-91.8 0.20 (1)	D-I	0 / 222	0.05 (1)	
D-E	-669 / 0	-91.8	-91.8 0.20 (1)	I-E	-105 / 24	0.05 (1)	
E-F	0 / 25	-91.8	-91.8 0.25 (1)	L-C	-917 / 0	0.65 (1)	
F-G	0 / 35	-91.8	-91.8 0.12 (1)	E-H	-917 / 0	0.65 (1)	
L-B	-284 / 0	0.0	0.0 0.04 (1)				
H-F	-284 / 0	0.0	0.0 0.04 (1)				
L-K	0 / 587	-18.5	-18.5 0.17 (4)				
K-J	0 / 466	-18.5	-18.5 0.16 (4)				
J-I	0 / 466	-18.5	-18.5 0.16 (4)				
I-H	0 / 587	-18.5	-18.5 0.17 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.25/1.00 (E-F:1), BC=0.17/1.00 (H-I:4),
WB=0.65/1.00 (C-L:1), SSI=0.15/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.61 (C) (INPUT = 0.90)
JSI METAL = 0.34 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007022

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408131	T12	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 MITek Industries, Inc. Sat Apr 25 10:07:29 2020 Page 1
ID:DMCubINVR6TstFoe31v6I zns11-17CCjhHxxwCazBhU 8Dm5Cj ?xJ9F7C2PblvGzNDbs

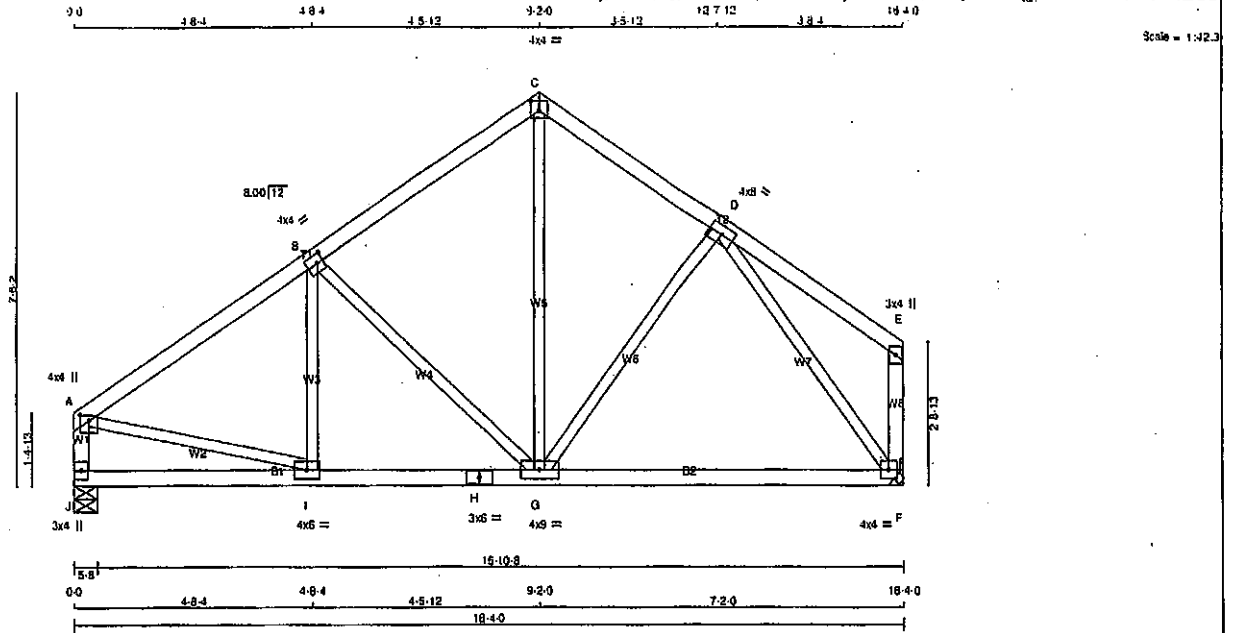

TOTAL WEIGHT = 3 X 71 = 214 lb [M/F]

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - E	2x4	DRY	No.2	SPF		
F - A	2x4	DRY	No.2	SPF		
J - E	2x4	DRY	No.2	SPF		
H - H	2x4	DRY	No.2	SPF		
H - F	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TMVW-l	MT20	4.0	4.0	2.00	1.50
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TMVW-l	MT20	4.0	4.0		
E	TMV+p	MT20	3.0	4.0		
F	BMVW-l	MT20	4.0	4.0		
G	BMVW-l	MT20	4.0	4.0		
H	BS-l	MT20	3.0	4.0		
I	BMVW-l	MT20	4.0	4.0		
J	BMV-l+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	IN-SX	IN-SX
J	900	0	900	0	0	0	5-8	5-8	
F	900	0	900	0	0	0	MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	637	418 / 0	0 / 0	0 / 0	0 / 0	0 / 0	219 / 0	0 / 0
F	637	418 / 0	0 / 0	0 / 0	0 / 0	0 / 0	219 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.17 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PL)	LC1 MAX	MAX. UNBRACED LENGTH	MEMB.	FORCE (LBS)	MAX. UNBRACED LENGTH	MEMB.	FORCE (LBS)
FR-TO					FR-TO			FR-TO	
A-B	-904 / 0	-91.8	-91.8	0.25 (1)	8.17	I-B	-104 / 28	0.03 (1)	
B-C	-648 / 0	-91.8	-91.8	0.25 (1)	8.25	B-G	-358 / 0	0.24 (1)	
C-D	-640 / 0	-91.8	-91.8	0.15 (1)	8.25	G-C	0 / 407	0.09 (1)	
D-E	0 / 21	-91.8	-91.8	0.19 (1)	10.00	G-D	-37 / 32	0.02 (1)	
J-A	-861 / 0	0.0	0.0	0.08 (1)	7.81	A-I	0 / 795	0.18 (1)	
F-E	-128 / 0	0.0	0.0	0.02 (1)	7.81	D-F	-886 / 0	0.54 (1)	
J-I	0 / 0	-18.5	-18.5	0.09 (4)	10.00				
I-H	0 / 775	-18.5	-18.5	0.26 (4)	10.00				
H-G	0 / 775	-18.5	-18.5	0.26 (4)	10.00				
G-F	0 / 537	-18.5	-18.5	0.24 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.54")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.02")
ALLOWABLE DEFL.(TL) = $L/360$ (0.54")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.09")

CSI: TC=0.25/1.00 (A-B:1), BC=0.25/1.00 (G-I:4), WB=0.54/1.00 (D-F:1), SS=0.17/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(FS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 798 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (A) (INPUT = 0.90)

JSI METAL = 0.29 (H) (INPUT = 1.00)




Structural component only
DWG# T-2007023

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408131	T13	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:07:31 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1f-bWJy7MJ9SXSCHCvrs5ZFEAdoJek2m6qLsvEp_9zNDbQ

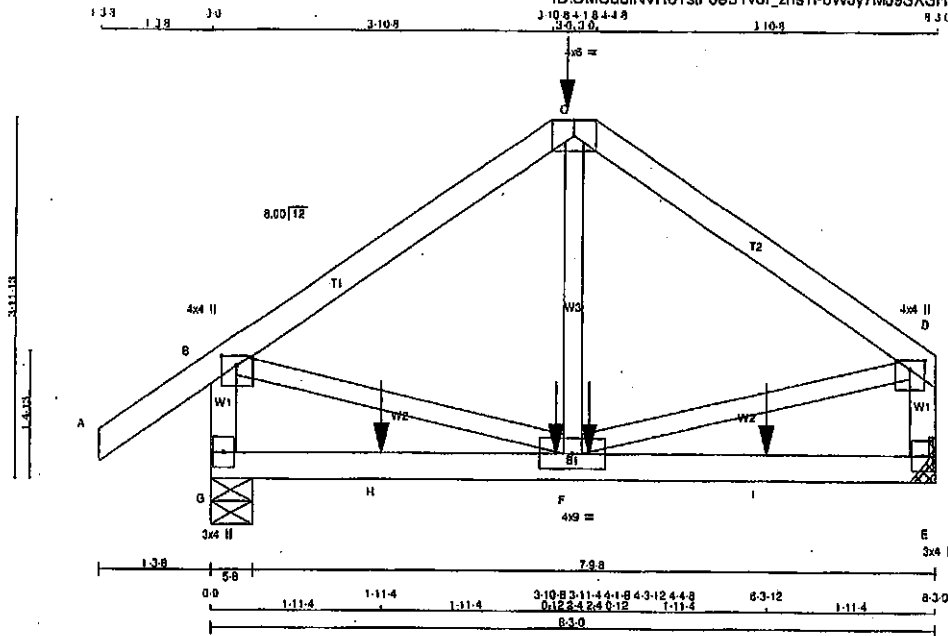

TOTAL WEIGHT = 34 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - B	2x4	DRY	No.2
E - D	2x4	DRY	No.2
G - E	2x4	DRY	No.2

ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
C	TTW+p	MT20	4.0	8.0	
D	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMV+p	MT20	3.0	4.0	
F	BMVW+p	MT20	4.0	9.0	
G	BMV+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
G	879	0	879	0	0	5-8	5-8		
E	753	0	753	0	0	MECHANICAL			

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 3-8.

UNFACTORED REACTIONS

1ST LOASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
G	519	420 / 0	0 / 0	0 / 0	0 / 0	199 / 0	0 / 0
E	533	350 / 0	0 / 0	0 / 0	0 / 0	183 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 35	-91.8 -91.8	0.14 (1)	10.00	B-F	0 / 586	0.15 (1)
B-C	-682 / 0	-91.8 -91.8	0.31 (1)	6.25	F-D	0 / 586	0.15 (1)
C-D	-682 / 0	-91.8 -91.8	0.31 (1)	6.25	F-C	-148 / 67	0.04 (1)
G-B	-842 / 0	0.0 0.0	0.10 (1)	7.81			
E-D	-716 / 0	0.0 0.0	0.08 (1)	7.81			
G-H	0 / 0	-18.5 -18.5	0.13 (4)	10.00			
H-F	0 / 0	-18.5 -18.5	0.13 (4)	10.00			
F-I	0 / 0	-18.5 -18.5	0.13 (4)	10.00			
I-E	0 / 0	-18.5 -18.5	0.13 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-1-8	-527	-527	---	BACK	VERT	TOTAL	---	C1
F	3-11-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
F	4-3-12	-17	-17	---	BACK	VERT	TOTAL	---	C1
H	1-11-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
I	6-3-12	-17	-17	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.28")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.31/1.00 (C-D:1), BC=0.13/1.00 (E-F:4), WB=0.15/1.00 (B-F:1), SSI=0.14/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.67 (B) (INPUT = 0.90)
JSI METAL = 0.20 (B) (INPUT = 1.00)

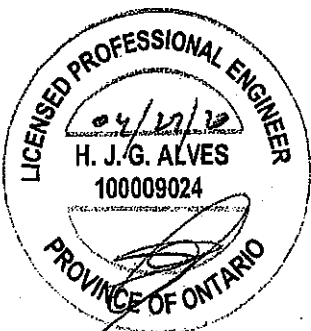


Structural component only
DWG# T-2007024

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408131	T14	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 10:07:32 2020 Page 1
ID:DMCubINVR8TstFpe31v6l_zns11-3ilKLiKnDra8qQ3iHnTiqLWS8NnSaKU5Z_MWbzNDbP

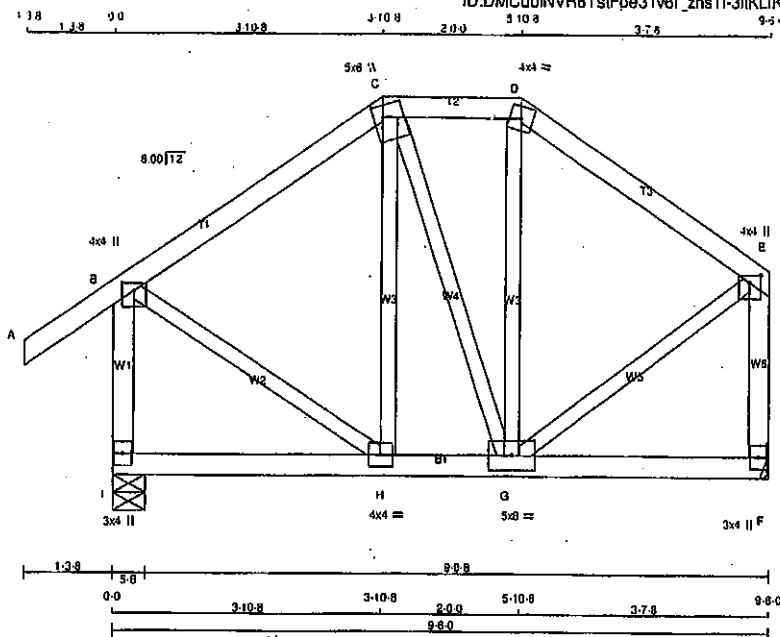

Scale = 1/31.1

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2	
C - D	2x4	DRY	No.2	
D - E	2x4	DRY	No.2	
E - F	2x4	DRY	No.2	
F - G	2x4	DRY	No.2	
G - H	2x4	DRY	No.2	

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TTWW+m	MT20	5.0	8.0	2.00	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMVW+p	MT20	4.0	4.0	1.25	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMWW-t	MT20	5.0	8.0		
H	BMWW-t	MT20	4.0	4.0		
I	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
I	650	0	850	0
F	524	0	524	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1.8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	457	313 / 0	0 / 0	0 / 0	0 / 0	0 / 0	144 / 0	0 / 0
F	370	243 / 0	0 / 0	0 / 0	0 / 0	0 / 0	127 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED	VERT. LOAD	LC1	MAX	CS1 (LC)	UNBRAC	MEMB.	WEBS	MAX. FACTORED	VERT. LOAD	LC1	MAX	CS1 (LC)
FR-TO							LENGTH	FR-TO						
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	H-C	-87 / 16	0.04 (1)						
B-C	-287 / 0	-91.8	-91.8	0.18 (1)	8.25	C-G	-19 / 0	0.01 (1)						
C-D	-238 / 0	-91.8	-91.8	0.05 (1)	6.25	G-D	-97 / 9	0.04 (1)						
D-E	-289 / 0	-91.8	-91.8	0.15 (1)	8.25	H-H	0 / 288	0.08 (1)						
E-F	-618 / 0	0.0	0.0	0.09 (1)	7.81	G-E	0 / 292	0.07 (1)						
F-G	-493 / 0	0.0	0.0	0.08 (1)	7.81									
I-H	0 / 0	-18.5	-18.5	0.08 (4)	10.00									
H-G	0 / 245	-18.5	-18.5	0.08 (4)	10.00									
G-F	0 / 0	-18.5	-18.5	0.05 (4)	10.00									

TOTAL WEIGHT = 2 X 50 = 99 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.32")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.32")
CALCULATED VERT. DEFL. (TL) = L/999 (0.01")

CSI: TC=0.18/1.00 (B-C:1), BC=0.08/1.00 (G-H:4), WB=0.07/1.00 (E-G:1), SS=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX	MIN	MAX
MT20	618	354
	1687	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.43 (B) (INPUT = 0.90)
JSI METAL = 0.13 (B) (INPUT = 1.00)

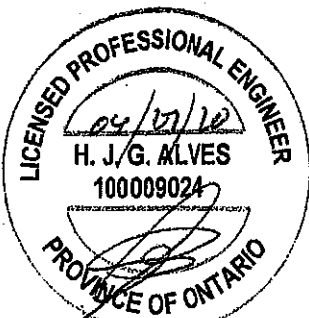


Structural component only
DWG# T-2007025

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408131	T15	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:07:33 2020 Page 1
ID:DMCubINVR6TstFoe31v6I zns1I-XvRY2KQ_8i?Sp?FD lIF2uhnYivB11eJDjv22zNDbo

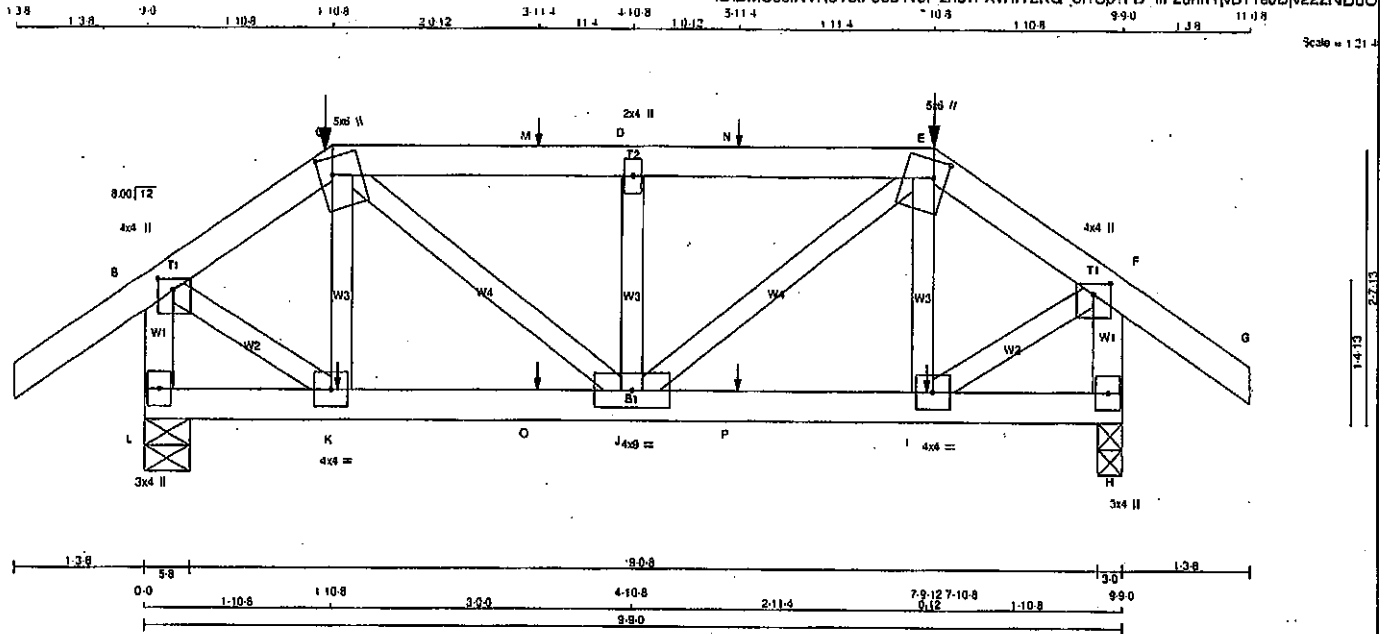

TOTAL WEIGHT = 43 b (lb)

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - H	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
C	TTWW+m	MT20	5.0	6.0	2.00 1.50
D	TMVW+w	MT20	2.0	4.0	
E	TTWW+m	MT20	5.0	6.0	2.00 1.50
F	TMVW+p	MT20	4.0	4.0	1.25 2.00
H	BMV1+p	MT20	3.0	4.0	
I	BMVW-t	MT20	4.0	4.0	
J	BMVW-t	MT20	4.0	9.0	
K	BMVW-t	MT20	4.0	4.0	
L	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED	MAXIMUM FACTORED		INPUT		REQD	
	GROSS REACTION	GROSS REACTION	BRG	GROSS REACTION	BRG		
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
L	706	0	706	0	0	5-8	5-8
H	706	0	706	0	0	3-0	3-0

UNFACTORED REACTIONS							
1ST CASE MAX/MIN COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	496	343 / 0	0 / 0	0 / 0	0 / 0	153 / 0	0 / 0
H	496	343 / 0	0 / 0	0 / 0	0 / 0	153 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	MAX.	MEMB.	MAX. FACTORED	FACTORED	MAX.
	FORCE	VERT. LOAD	LC1 MAX		FORCE	VERT. LOAD	LC1 MAX
FR-TO	(LBS)	(PLF)	CSI (LC)	FR-TO	(LBS)	(PLF)	CSI (LC)
A-B	0 / 35	-91.8	-91.8 0.14 (1)	10.00	K-C	-140 / 0	0.02 (1)
B-C	-458 / 0	-91.8	-91.8 0.13 (1)	8.25	C-J	0 / 304	0.08 (1)
C-M	-590 / 0	-91.8	-91.8 0.14 (1)	8.25	J-D	-329 / 0	0.06 (1)
M-D	-590 / 0	-91.8	-91.8 0.14 (1)	8.25	D-E	0 / 304	0.08 (1)
D-N	-590 / 0	-91.8	-91.8 0.14 (1)	8.25	E-F	-140 / 0	0.02 (1)
N-E	-590 / 0	-91.8	-91.8 0.14 (1)	8.25	F-G	0 / 407	0.10 (1)
E-F	-458 / 0	-91.8	-91.8 0.13 (1)	8.25	G-H	0 / 407	0.10 (1)
F-G	0 / 35	-91.8	-91.8 0.14 (1)	10.00			
L-B	-693 / 0	0.0	0.0 0.08 (1)	7.81			
H-F	-693 / 0	0.0	0.0 0.08 (1)	7.81			
L-K	0 / 0	-18.5	-18.5 0.03 (4)	10.00			
K-O	0 / 351	-18.5	-18.5 0.08 (1)	10.00			
O-J	0 / 351	-18.5	-18.5 0.08 (1)	10.00			
J-P	0 / 351	-18.5	-18.5 0.08 (1)	10.00			
P-I	0 / 351	-18.5	-18.5 0.08 (1)	10.00			
I-H	0 / 0	-18.5	-18.5 0.03 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE
C	1-10-8	-42	-42	115	BACK	VERT	TOTAL
E	7-10-8	-42	-42	115	BACK	VERT	TOTAL
I	7-9-12	1	1	---	BACK	VERT	TOTAL
K	1-11-4	1	1	---	BACK	VERT	TOTAL
M	3-11-4	1	1	115	BACK	VERT	TOTAL
N	5-11-4	1	1	115	BACK	VERT	TOTAL
O	3-11-4	1	1	---	BACK	VERT	TOTAL
P	5-11-4	1	1	---	BACK	VERT	TOTAL

CONNECTION REQUIREMENTS
1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.32")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.32")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.14/1.00 (D-E:1), BC=0.08/1.00 (J-K:1), WB=0.10/1.00 (F-I:1), SS=0.14/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.48 (F) (INPUT = 0.90)
JSI METAL = 0.14 (F) (INPUT = 1.00)

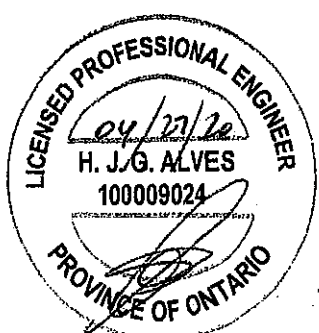


Structural component only
DWG# T-2007026


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408131	T16	1	2	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington
Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 10:07:34 2020 Page 2
ID:DMCubINVR6TstFee31v6I zns1I-0525mOL2ISrs3zeRnhpxoFQpGv08wRonYtTTbUzNDbN

PLATES (table is in inches)
JT TYPE
PLATES
W
LEN
Y
X
F
BMV1+p
MT20
3.0
4.0

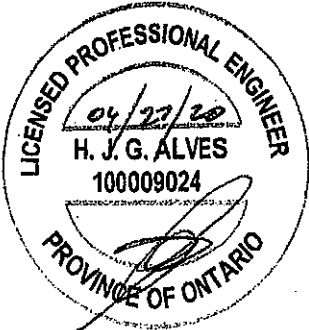

Structural component only
DWG# T-2007027 42

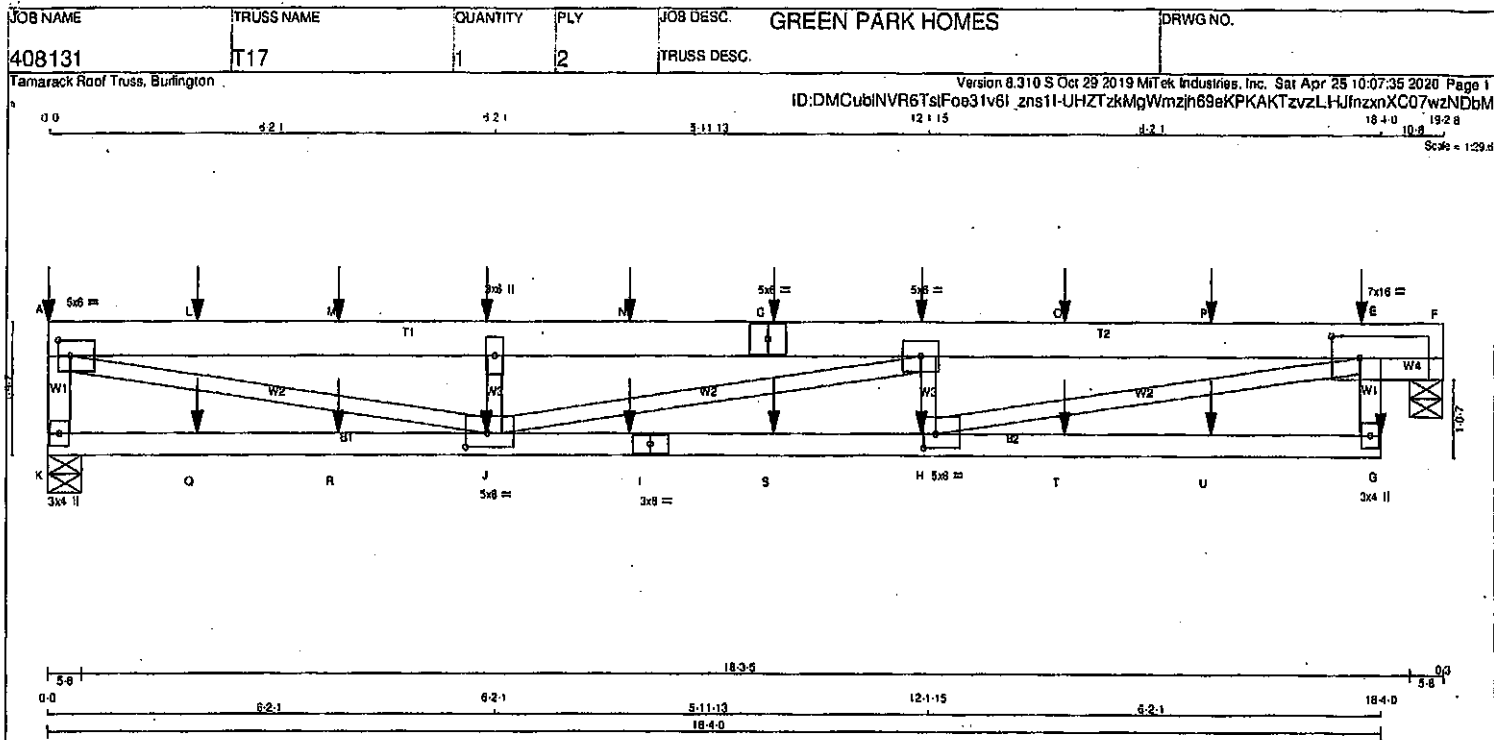

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
K - A	2x4	DRY	No.2	SPF
A - C	2x6	DRY	No.2	SPF
C - F	2x6	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
K - A 1	12	TOP
E - G 1	6	SIDE(35.8)
A - C 2	12	SIDE(183.1)
C - F 2	12	SIDE(183.1)
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
K - I 1	12	SIDE(61.0)
I - G 1	12	SIDE(61.0)
WEBS: (0.122"x3") SPIRAL NAILS		
H - D 1	6	SIDE(34.0)
J - B 1	6	SIDE(34.0)
2x3 1	6	
2x4 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	IN-SX	IN-SX
K	1740	0	5-8	5-8
F	1870	0	5-8	5-8

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): F

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX/MIN. SNOW	MIN. LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	1229	818 / 0	0 / 0	0 / 0	0 / 0	413 / 0	0 / 0
F	1180	779 / 0	0 / 0	0 / 0	0 / 0	401 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.19 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBB				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO			FR-TO			
K-A	-1645 / 0	0.0	0.0	0.09 (1)	7.81	H-E	0 / 5759	0.71 (1)
A-L	-5118 / 0	-91.8	-91.8	0.26 (1)	4.91	A-J	0 / 5250	0.65 (1)
L-M	-5119 / 0	-91.8	-91.8	0.26 (1)	4.91	H-D	-1023 / 0	0.08 (1)
M-B	-5118 / 0	-91.8	-91.8	0.26 (1)	4.91	J-B	-775 / 0	0.08 (1)
B-N	-5118 / 0	-91.8	-91.8	0.19 (1)	4.99	J-D	-510 / 0	0.18 (1)
N-C	-5118 / 0	-91.8	-91.8	0.19 (1)	4.99			
C-D	-5118 / 0	-91.8	-91.8	0.19 (1)	4.99			
D-O	-5615 / 0	-91.8	-91.8	0.61 (1)	4.19			
O-P	-5615 / 0	-91.8	-91.8	0.61 (1)	4.18			
P-E	-5615 / 0	-91.8	-91.8	0.61 (1)	4.19			
E-F	-653 / 0	-91.8	-91.8	0.32 (1)	6.25			
G-E	0 / 154	0.0	0.0	0.01 (4)	10.00			
K-Q	0 / 0	-18.5	-18.5	0.12 (4)	10.00			
Q-R	0 / 0	-18.5	-18.5	0.12 (4)	10.00			
R-J	0 / 0	-18.5	-18.5	0.12 (4)	10.00			
J-I	0 / 5615	-18.5	-18.5	0.80 (1)	10.00			
I-S	0 / 5615	-18.5	-18.5	0.80 (1)	10.00			
S-H	0 / 5615	-18.5	-18.5	0.60 (1)	10.00			
H-T	0 / 0	-18.5	-18.5	0.13 (1)	10.00			
T-U	0 / 0	-18.5	-18.5	0.13 (1)	10.00			
U-G	0 / 0	-18.5	-18.5	0.13 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
A	0-0	-125	-125	---	BACK	VERT	TOTAL	---	C1
B	0-0-12	-82	-82	---	BACK	VERT	TOTAL	---	C1
C	10-0-12	-82	-82	---	BACK	VERT	TOTAL	---	C1
D	12-0-12	-82	-82	---	BACK	VERT	TOTAL	---	C1
E	18-0-12	-82	-82	---	BACK	VERT	TOTAL	---	C1
G	18-4-0	-56	-56	---	BACK	VERT	TOTAL	---	C1
H	12-0-12	-49	-49	---	BACK	VERT	TOTAL	---	C1
I	8-0-12	-49	-49	---	BACK	VERT	TOTAL	---	C1
J	6-0-12	-49	-49	---	BACK	VERT	TOTAL	---	C1
L	2-0-12	-82	-82	---	BACK	VERT	TOTAL	---	C1
M	4-0-12	-82	-82	---	BACK	VERT	TOTAL	---	C1
N	8-0-12	-82	-82	---	BACK	VERT	TOTAL	---	C1
O	14-0-12	-82	-82	---	BACK	VERT	TOTAL	---	C1
P	16-0-12	-82	-82	---	BACK	VERT	TOTAL	---	C1
Q	2-0-12	-49	-49	---	BACK	VERT	TOTAL	---	C1

TOTAL WEIGHT = 2 X 75 = 149 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 8.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(35% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.61")
CALCULATED VERT. DEFL.(LL) = $L/984$ (0.23")
ALLOWABLE DEFL.(TL) = $L/360$ (0.61")
CALCULATED VERT. DEFL.(TL) = $L/521$ (0.42")

CSI: TC=0.61/1.00 (D-E:1), BC=0.60/1.00 (H-J:1),
WB=0.71/1.00 (E-H:1), SSI=0.31/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX MIN
MT20	618	354 1687
	78B	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (J) (INPUT = 0.90)
JSI METAL= 0.95 (I) (INPUT = 1.00)



Structural component only
DWG# T-2007028 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408131	T17	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 10:07:35 2020 Page 2
ID:DMCubINVR6TslFoe31v6l_zns1l-UHZTzkMgWmzih69eKPKAKTzvzLHJmzxnxXC07wzNDbM

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-I	MT20	5.0	8.0	2.50	2.00
B	TMVW-w	MT20	3.0	6.0		
C	TS-I	MT20	5.0	8.0		
D	TMVW-I	MT20	5.0	8.0		
E	TMVW-I	MT20	7.0	16.0	3.50	4.50
G	BMV-p	MT20	3.0	4.0		
H	BMVW-I	MT20	5.0	8.0	2.25	2.00
I	BS-I	MT20	3.0	8.0		
J	BMVW-I	MT20	5.0	8.0	2.25	3.50
K	BMV-I-p	MT20	3.0	4.0		

FACTORED CONCENTRATED LOADS (LBS)


JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
R	4-0-12	-49	-49	---	BACK	VERT	TOTAL	---	C1
S	10-0-12	-49	-49	---	BACK	VERT	TOTAL	---	C1
T	14-0-12	-49	-49	---	BACK	VERT	TOTAL	---	C1
U	16-0-12	-49	-49	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007028 2/2

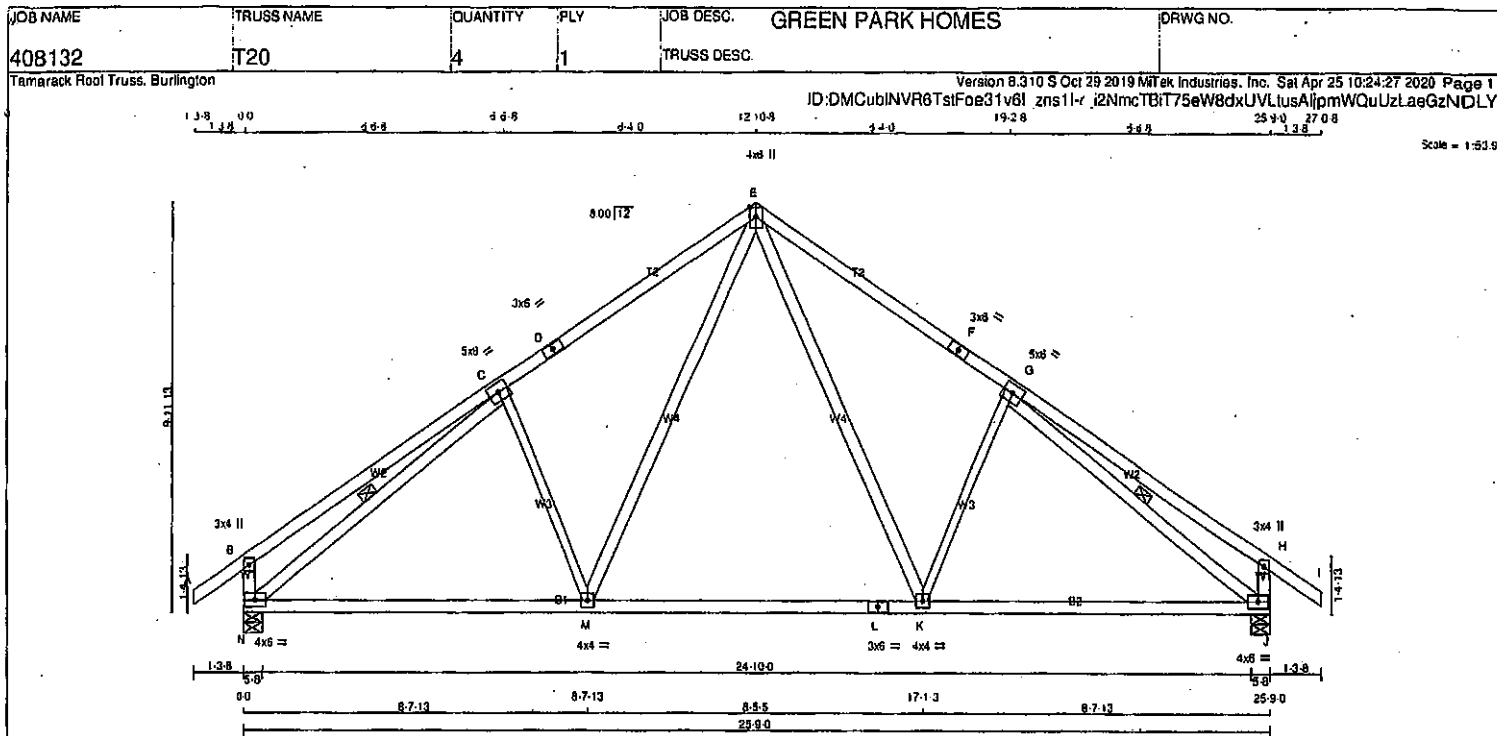

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
N - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
ALL WEBS	2x4	DRY	No.2	SPF
EXCEPT				
K - G	2x3	DRY	No.2	SPF
C - M	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	5.0	6.0		
D	TS-t	MT20	3.0	6.0		
E	TTWW+p	MT20	4.0	6.0	Edge	
F	TS-t	MT20	3.0	6.0		
G	TMWW-t	MT20	5.0	6.0		
H	TMV+p	MT20	3.0	4.0		
J	BMWW-t	MT20	4.0	6.0		
K	BMWW-t	MT20	4.0	4.0		
L	BS-t	MT20	3.0	6.0		
M	BMWW-t	MT20	4.0	4.0		
N	BMWW-t	MT20	4.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
N	1545	0	1545	0
J	1545	0	1545	0

UNFACTORED REACTIONS

1ST LCASE	MAX MIN COMPONENT REACTIONS	PERM LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND
N	1091	729 / 0	0 / 0	0 / 0	362 / 0
J	1091	729 / 0	0 / 0	0 / 0	362 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, G-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	E-K	0 / 619	0.10 (1)
B-C	0 / 40	-91.8	-91.8 0.63 (1)	10.00	K-G	-428 / 0	0.25 (1)
C-D	-1469 / 0	-91.8	-91.8 0.58 (1)	4.72	M-E	0 / 619	0.10 (1)
D-E	-1469 / 0	-91.8	-91.8 0.58 (1)	4.72	C-M	-428 / 0	0.25 (1)
E-F	-1469 / 0	-91.8	-91.8 0.58 (1)	4.72	N-C	-1767 / 0	0.59 (1)
F-G	-1469 / 0	-91.8	-91.8 0.58 (1)	4.72	G-J	-1767 / 0	0.59 (1)
G-H	0 / 40	-91.8	-91.8 0.63 (1)	10.00			
H-I	0 / 35	-91.8	-91.8 0.12 (1)	10.00			
N-B	-347 / 0	0.0	0.0 0.04 (1)	7.81			
J-H	-347 / 0	0.0	0.0 0.04 (1)	7.81			
N-M	0 / 1356	-18.5	-18.5 0.42 (4)	10.00			
M-L	0 / 942	-18.5	-18.5 0.39 (4)	10.00			
L-K	0 / 942	-18.5	-18.5 0.39 (4)	10.00			
K-J	0 / 1356	-18.5	-18.5 0.42 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.88")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (0.88")
CALCULATED VERT. DEFL.(TL) = L/999 (0.19")

CSI: TC=0.63/1.00 (B-C:1), BC=0.42/1.00 (J-K:4), WB=0.59/1.00 (C-N:1), SS=0.24/1.00 (C-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	610 354	1667 788	1967 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.87 (J) (INPUT = 0.90)
JSI METAL=0.46 (G) (INPUT = 1.00)




Structural component only
DWG# T-2007030

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408132	T21	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 10:24:28 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-JAGQa6c5y7b Jo5KAf?ku4Q70i7hV c1jd57AizNDLX

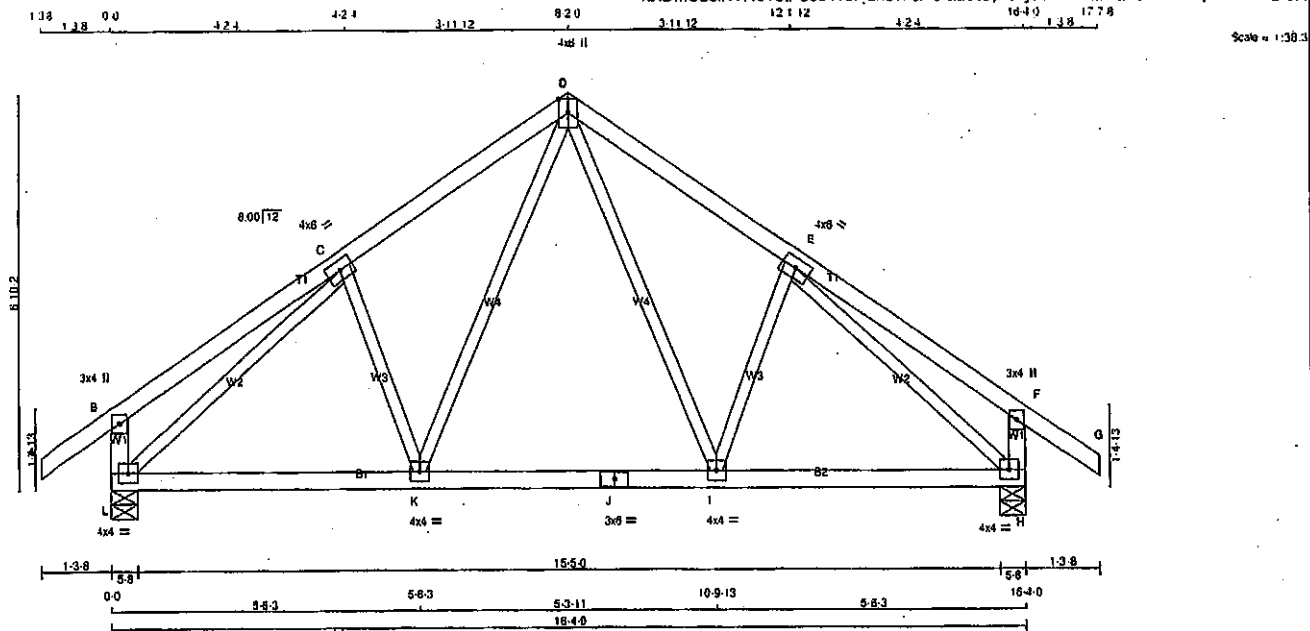

TOTAL WEIGHT = 4 X 73 = 291 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
L - B	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2
EXCEPT

ORY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-i	MT20	4.0	6.0		
D	TTWW+p	MT20	4.0	6.0	Edge	
E	TMWW-i	MT20	4.0	6.0		
F	TMV+p	MT20	3.0	4.0		
H	BMVW-i	MT20	4.0	4.0		
I	BMVW-i	MT20	4.0	4.0		
J	BS-i	MT20	3.0	6.0		
K	BMVW-i	MT20	4.0	4.0		
L	BMVW-i	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
L	1028	0	1028	0
H	1028	0	1028	0

UNFACTORED REACTIONS

1ST CASE	MAX/MIN COMPONENT REACTIONS	DEAD	SOIL
JT	COMBINED		
L	723	488 / 0	0 / 0
H	723	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	FACTORED	FACTORED	WEBS	MAX. FACTORED	FACTORED	FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	LC1 (PLF)	MAX CS1 (LC)	MEMB.	FORCE (LBS)	MAX CS1 (LC)	MAX CS1 (LC)
FR-TO		FROM	TO		FR-TO			
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	D-I	0 / 338	0.08 (1)
B-C	0 / 24	-91.8	-91.8	0.24 (1)	10.00	E-H	-219 / 0	0.06 (1)
C-D	-851 / 0	-91.8	-91.8	0.19 (1)	8.25	K-D	0 / 338	0.08 (1)
D-E	-851 / 0	-91.8	-91.8	0.19 (1)	8.25	C-K	-219 / 0	0.06 (1)
E-F	0 / 24	-91.8	-91.8	0.24 (1)	10.00	L-C	-1048 / 0	0.53 (1)
F-G	0 / 35	-91.8	-91.8	0.12 (1)	10.00	E-H	-1048 / 0	0.53 (1)
L-B	-289 / 0	0.0	0.0	0.03 (1)	7.81			
H-F	-289 / 0	0.0	0.0	0.03 (1)	7.81			
L-K	0 / 767	-18.5	-18.5	0.19 (1)	10.00			
K-J	0 / 561	-18.5	-18.5	0.17 (4)	10.00			
J-I	0 / 561	-18.5	-18.5	0.17 (4)	10.00			
I-H	0 / 767	-18.5	-18.5	0.19 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.54")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.02")
ALLOWABLE DEFL.(TL) = $L/360$ (0.54")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.05")

CSI: TC=0.24/1.00 (B-C:1), BC=0.19/1.00 (H-I:1), WB=0.53/1.00 (C-L:1), SS=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.89 (H) (INPUT = 0.90)
JSI METAL= 0.29 (L) (INPUT = 1.00)

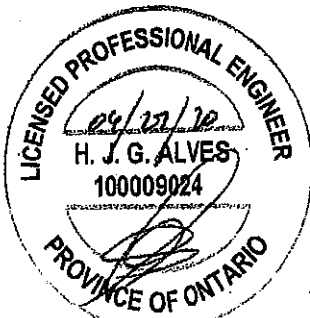

Structural component only
DWG# T-2007031

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408132	T21S	2	1	GREEN PARK HOMES		
Tamarack Roof Truss, Burlington						

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 10:24:29 2020 Page 1
ID:DMCubINVR6TstFoe31v6l zns11-oMgonSdijJrLypWkMWzQizEG5QJEQByHqg9zNDLW

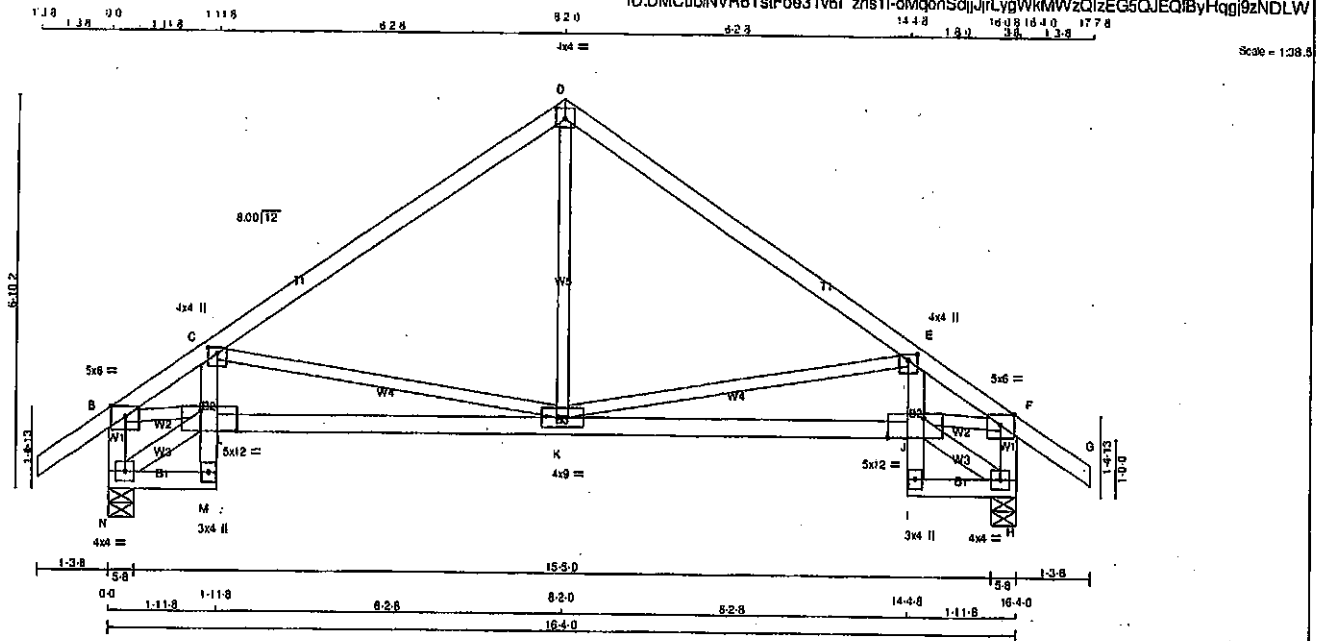

TOTAL WEIGHT = 2 X 72 = 145 lb

LUMBER				N. L. G. A. RULES	
CHORDS	SIZE	LUMBER	DESCR.	SPF	SPF
A - D	2x4	DRY	No.2	SPF	SPF
D - G	2x4	DRY	No.2	SPF	SPF
N - B	2x4	DRY	No.2	SPF	SPF
H - F	2x4	DRY	No.2	SPF	SPF
N - M	2x4	DRY	No.2	SPF	SPF
M - C	2x4	DRY	No.2	SPF	SPF
L - J	2x4	DRY	No.2	SPF	SPF
I - E	2x4	DRY	No.2	SPF	SPF
I - H	2x4	DRY	No.2	SPF	SPF
ALL WEBS	2x3	DRY	No.2	SPF	SPF
EXCEPT					
N - L	2x4	DRY	No.2	SPF	SPF
J - H	2x4	DRY	No.2	SPF	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge
C	TMVW-p	MT20	4.0	4.0	1.25 2.00
D	TMVW-p	MT20	4.0	4.0	2.25 2.00
E	TMVW-p	MT20	4.0	4.0	1.25 2.00
F	TMVW-p	MT20	5.0	6.0	Edge
H	BMVW1-t	MT20	4.0	4.0	
I	BMV-p	MT20	3.0	4.0	
J	BMVWVW-I	MT20	5.0	12.0	4.00 8.00
K	BMVWVW-I	MT20	4.0	9.0	
L	BMVWVW-I	MT20	5.0	12.0	4.00 8.00
M	BMV-p	MT20	3.0	4.0	
N	BMVW1-t	MT20	4.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
N	1026	0	1026	0	0	5-8	5-8
H	1026	0	1026	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
N	723	488 / 0	0 / 0	0 / 0	0 / 0	235 / 0	0 / 0
H	723	488 / 0	0 / 0	0 / 0	0 / 0	235 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.83 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PL)	MAX. (LC1)	MEMB.	FORCE (LBS)	MAX. (LC)	UNBRACED LENGTH
FR-TO		FROM	TO	FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	K-D	0 / 405	0.09 (1)
B-C	-1592 / 0	-91.8	-91.8 0.36 (1)	4.83	K-E	-787 / 0	0.81 (1)
C-D	-828 / 0	-91.8	-91.8 0.47 (1)	6.01	C-K	-787 / 0	0.81 (1)
D-E	-828 / 0	-91.8	-91.8 0.47 (1)	6.01	N-L	-68 / 0	0.01 (1)
E-F	-1592 / 0	-91.8	-91.8 0.36 (1)	4.83	B-L	0 / 1383	0.31 (1)
F-G	0 / 35	-91.8	-91.8 0.12 (1)	10.00	J-H	-68 / 0	0.01 (1)
N-B	-974 / 0	0.0	0.0 0.10 (1)	7.81	J-F	0 / 1383	0.31 (1)
H-F	-974 / 0	0.0	0.0 0.10 (1)	7.81			
N-M	0 / 58	-18.5	-18.5 0.02 (4)	10.00			
M-L	0 / 19	0.0	0.0 0.09 (1)	10.00			
L-C	0 / 84	0.0	0.0 0.10 (1)	10.00			
L-K	0 / 1438	-18.5	-18.5 0.36 (1)	10.00			
K-J	0 / 1438	-18.5	-18.5 0.36 (1)	10.00			
I-J	0 / 19	0.0	0.0 0.09 (1)	10.00			
J-E	0 / 84	0.0	0.0 0.10 (1)	10.00			
I-H	0 / 58	-18.5	-18.5 0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIG 2011, TPIG 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.54")
CALCULATED VERT. DEFL. (LL) = L/999 (0.03")
ALLOWABLE DEFL. (TL) = L/360 (0.54")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.47/1.00 (C-D:1), BC=0.36/1.00 (K-L:1),
WB=0.61/1.00 (C-K:1), SS=0.22/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788 1987 1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.69 (F) (INPUT = 0.90)
JSI METAL = 0.33 (L) (INPUT = 1.00)

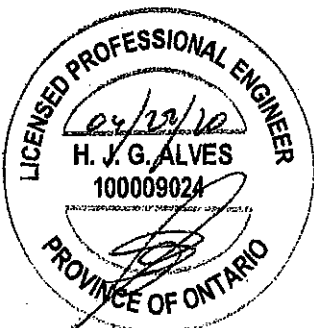

Structural component only
DWG# T-2007032

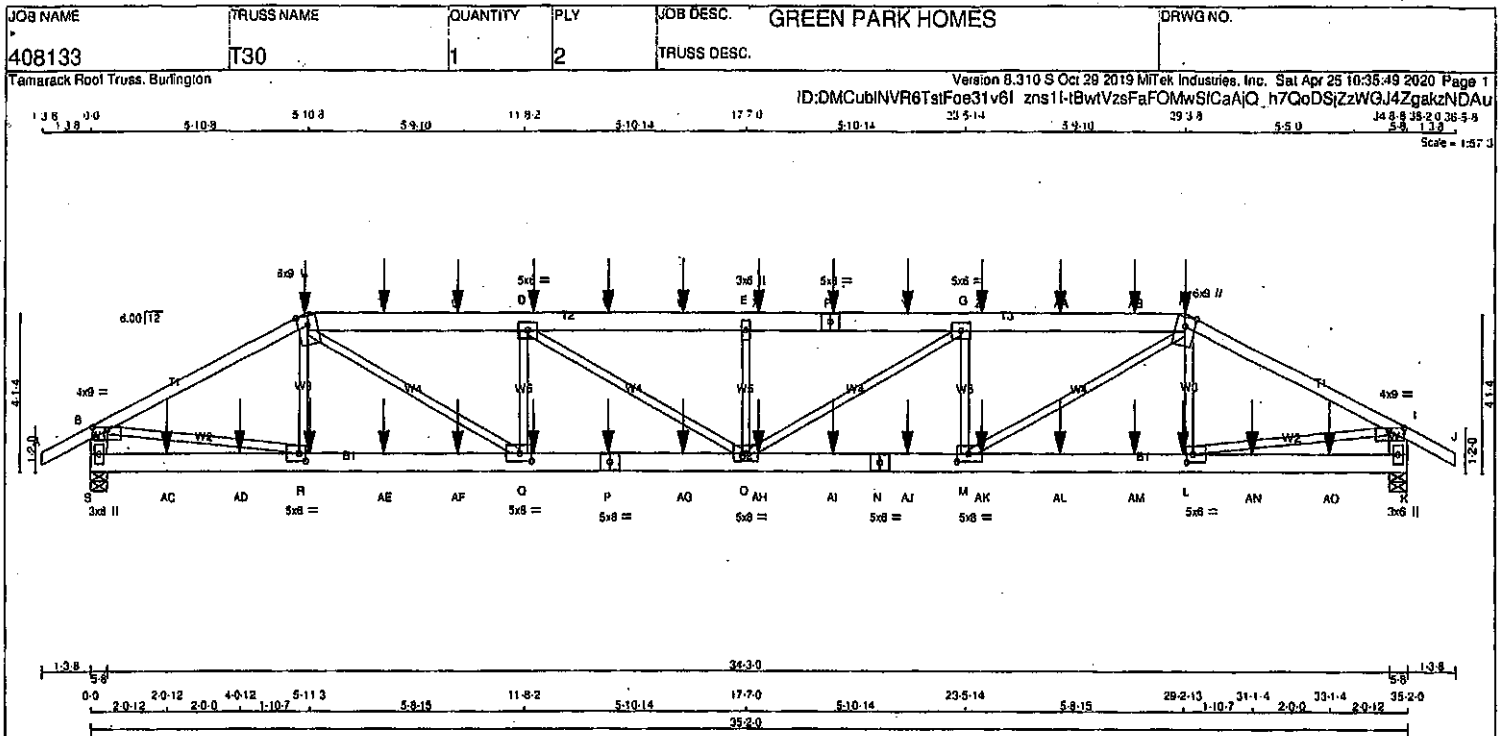

TOTAL WEIGHT = 2 X 169 = 338 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - F	2x6	DRY	No.2	SPF
F - H	2x6	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF
S - B	2x6	DRY	No.2	SPF
K - I	2x6	DRY	No.2	SPF
S - P	2x6	DRY	No.2	SPF
P - N	2x6	DRY	No.2	SPF
N - K	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C	12	SIDE (81.0)
H-J	12	SIDE (81.0)
C-F	12	SIDE (183.1)
F-H	12	SIDE (81.0)
S-B	12	TOP
K-I	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
S-P	12	SIDE (183.1)
P-N	12	SIDE (0.0)
N-K	12	SIDE (183.1)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	IN-SX	IN-SX
S	3322	0	5-8	5-8
K	3350	0	5-8	5-8

UNFACTORED REACTIONS

	1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	2350	1638 / 0	0 / 0	0 / 0	0 / 0	812 / 0	0 / 0
K	2370	1550 / 0	0 / 0	0 / 0	0 / 0	820 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.85 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	UNBRAC LENGTH	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO					FR-TO		
A-B	0 / 28	-91.8	-91.8	0.07 (1)	10.00	R-C	-413 / 18
B-C	-5084 / 0	-91.8	-91.8	0.52 (1)	3.87	L-H	-411 / 24
C-T	-7207 / 0	-91.8	-91.8	0.26 (1)	4.28	B-R	0 / 4501
T-U	-7207 / 0	-91.8	-91.8	0.26 (1)	4.28	L-I	0 / 4825
U-D	-7207 / 0	-91.8	-91.8	0.26 (1)	4.28	M-H	0 / 3123
V-V	-8028 / 0	-91.8	-91.8	0.26 (1)	4.09	C-Q	0 / 3143
D-W	-8028 / 0	-91.8	-91.8	0.26 (1)	4.09	M-G	-1484 / 0
W-E	-8028 / 0	-91.8	-91.8	0.26 (1)	4.09	Q-D	-1496 / 0
E-X	-8028 / 0	-91.8	-91.8	0.27 (1)	4.08	O-G	0 / 933
X-F	-8028 / 0	-91.8	-91.8	0.27 (1)	4.08	D-O	0 / 985
F-Y	-8028 / 0	-91.8	-91.8	0.27 (1)	4.08	O-E	-821 / 0
Y-G	-8028 / 0	-91.8	-91.8	0.27 (1)	4.08		
G-Z	-7234 / 0	-91.8	-91.8	0.26 (1)	4.27		
Z-AA	-7234 / 0	-91.8	-91.8	0.26 (1)	4.27		
AA-AB	-7234 / 0	-91.8	-91.8	0.26 (1)	4.27		
AB-H	-7234 / 0	-91.8	-91.8	0.26 (1)	4.27		
H-I	-5114 / 0	-91.8	-91.8	0.52 (1)	3.85		
I-J	0 / 28	-91.8	-91.8	0.07 (1)	10.00		
S-B	-3248 / 0	0.0	0.0	0.11 (1)	7.69		
K-I	-3276 / 0	0.0	0.0	0.12 (1)	7.67		

S-AC	0 / 0	-18.5	-18.5	0.06 (4)	10.00
AC-AD	0 / 0	-18.5	-18.5	0.06 (4)	10.00
AD-R	0 / 0	-18.5	-18.5	0.06 (4)	10.00
R-AE	0 / 4552	-18.5	-18.5	0.34 (1)	10.00
AE-AF	0 / 4552	-18.5	-18.5	0.34 (1)	10.00
AF-Q	0 / 4552	-18.5	-18.5	0.34 (1)	10.00
Q-P	0 / 7208	-18.5	-18.5	0.53 (1)	10.00
P-AG	0 / 7208	-18.5	-18.5	0.53 (1)	10.00
AG-O	0 / 7208	-18.5	-18.5	0.53 (1)	10.00
O-AH	0 / 7234	-18.5	-18.5	0.53 (1)	10.00
AH-AI	0 / 7234	-18.5	-18.5	0.53 (1)	10.00
AI-N	0 / 7234	-18.5	-18.5	0.53 (1)	10.00
N-AJ	0 / 7234	-18.5	-18.5	0.53 (1)	10.00
AJ-M	0 / 7234	-18.5	-18.5	0.53 (1)	10.00
M-AK	0 / 4596	-18.5	-18.5	0.35 (1)	10.00
AK-AL	0 / 4596	-18.5	-18.5	0.35 (1)	10.00
AL-AM	0 / 4596	-18.5	-18.5	0.35 (1)	10.00
AM-L	0 / 4596	-18.5	-18.5	0.35 (1)	10.00
L-AN	0 / 0	-18.5	-18.5	0.09 (4)	10.00
AN-AO	0 / 0	-18.5	-18.5	0.09 (4)	10.00
AO-K	0 / 0	-18.5	-18.5	0.06 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 8.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/899 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/899 (0.39")

CSI: TO=0.52/1.00 (H-I:1), BC=0.53/1.00 (M-O:1),
WB=0.57/1.00 (L-I:1), SS=0.18/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1667 788 1987 1856	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.72 (R) (INPUT = 0.90)
JSI METAL = 0.68 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007041

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408133	T30	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:35:49 2020 Page 2
ID:DMCubINVR6TstFob31v6l zns1l-BwVzFaFOMwSiCaAQ h7QoDSizWGJ4ZgakzNDAu

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	4.0	9.0	1.00	4.75
C	TTWW+m	MT20	6.0	9.0	Edge	
D	TMWW-i	MT20	5.0	6.0		
E	TMWW-w	MT20	3.0	6.0		
F	TS-i	MT20	5.0	6.0		
G	TMWW-i	MT20	5.0	6.0		
H	TTWW+m	MT20	6.0	9.0	Edge	
I	TMWW-p	MT20	4.0	9.0	1.00	4.75
K	BMV1-p	MT20	3.0	6.0		
L	BMWW-i	MT20	5.0	6.0	2.50	2.00
M	BMWW-i	MT20	5.0	6.0	2.50	3.75
N	BS-i	MT20	5.0	6.0		
O	BMWW-i	MT20	5.0	6.0		
P	BS-i	MT20	5.0	6.0		
Q	BMWW-i	MT20	5.0	6.0	2.50	3.75
R	BMWW-i	MT20	5.0	6.0	2.50	2.00
S	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-441	-441	---	BACK	VERT	TOTAL	---	C1
D	11-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
F	19-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
H	29-3-8	-441	-441	---	BACK	VERT	TOTAL	---	C1
L	29-2-13	-28	-28	---	BACK	VERT	TOTAL	---	C1
P	13-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
Q	11-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
R	5-11-3	-28	-28	---	BACK	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	13-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	15-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
X	17-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
Y	21-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
Z	23-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AA	25-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AB	27-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AC	2-0-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
AD	4-0-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
AE	7-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AF	9-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AG	15-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AH	17-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AI	19-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AJ	21-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AK	23-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AL	25-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AM	27-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AN	31-1-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AO	33-1-4	-28	-28	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007041



JSI GRIP= 0.90 (R) (INPUT = 0.80)
JSI METAL= 0.91 (P) (INPUT = 1.00)



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408133	T30Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 9 Oct 29 2019 MITek Industries, Inc. Sat Apr 25 10:35:50 2020 Page 2
ID:DMCubINVR8TstFoe31v8l zns1I-LNUFJltuLYWDXbEP7uEIXvgatciQINbQYkID8BzNDAI

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	9.0	1.00	4.75
C	TTWW+m	MT20	6.0	9.0	Edge	
D	TMWW-i	MT20	5.0	6.0		
E	TMW+w	MT20	3.0	6.0		
F	TS-i	MT20	5.0	6.0		
G	TMWW-i	MT20	5.0	6.0		
H	TTWW+m	MT20	6.0	9.0	Edge	
I	TMVW-p	MT20	4.0	9.0	1.00	4.75
K	BMV1+p	MT20	3.0	6.0		
L	BMWW-i	MT20	5.0	6.0	2.50	2.00
M	BMWW-i	MT20	5.0	6.0	2.50	3.75
N	BS-i	MT20	5.0	6.0		
O	BMWWW-i	MT20	5.0	6.0		
P	BS-i	MT20	5.0	6.0		
Q	BMWW-i	MT20	5.0	6.0	2.50	3.75
R	BMWW-i	MT20	5.0	6.0	2.50	2.00
S	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007042 32

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408133	T37	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:35:51 2020 Page 1
ID:DMCubINV6TstFoe31v6l_zns1f-qZ2dwtW6se49lphblu36Ds09l1vKZnO2medzNDAs

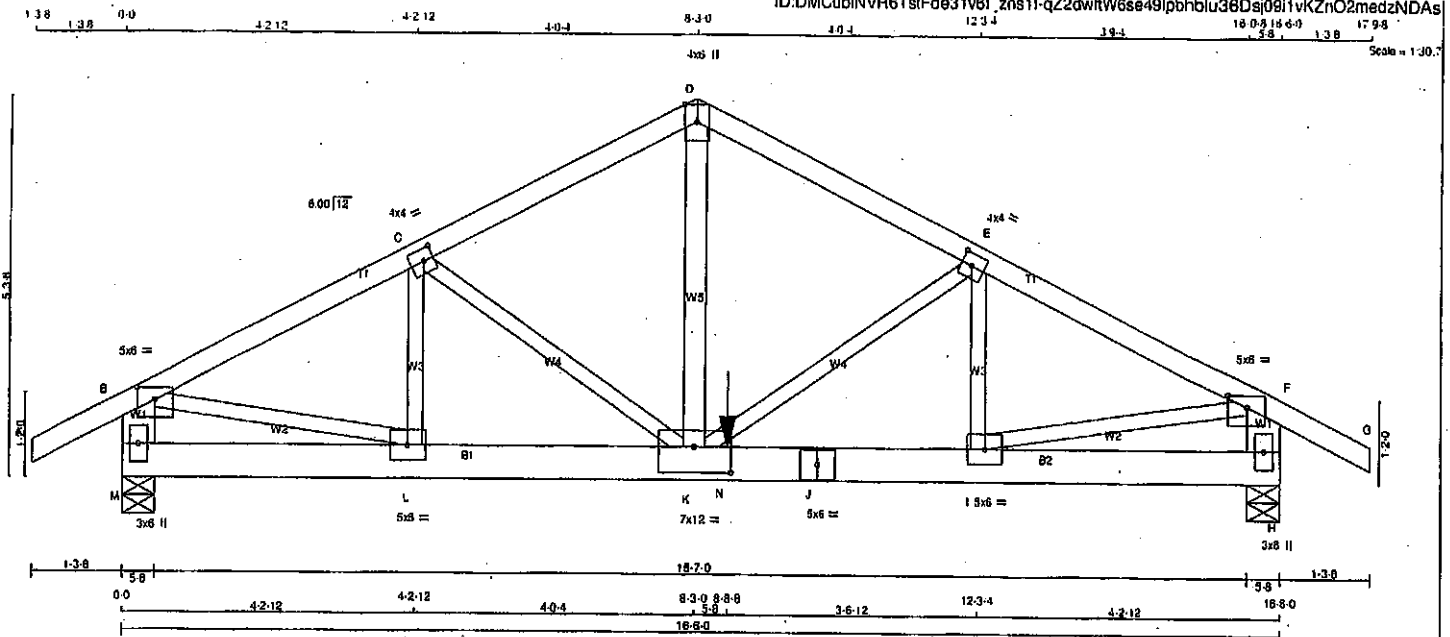

TOTAL WEIGHT = 2 X 79 = 158 lb

N. L. G. A. RULES			
CHORDS	SIZE	DRY	DESCR.
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
M - B	2x6	DRY	No.2
H - F	2x6	DRY	No.2
M - J	2x6	DRY	No.2
J - H	2x6	DRY	No.2

ALL WEBS EXCEPT			
CHORDS	SIZE	DRY	DESCR.
K - O	2x4	DRY	No.2

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-D 1	12	TOP
D-G 1	12	TOP
M-B 2	12	TOP
H-F 2	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
M-J 2	12	SIDE(0.0)
J-H 2	12	TOP
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1	6	
2x4 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	
JT	VERT	DOWN	HORIZ	UPLIFT	IN-SX
M	2447	0	2447	0	5-8
H	2613	0	2613	0	5-8

UNFACTORED REACTIONS						
1ST LCASE	MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
M	1733	1123/0	0/0	0/0	0/0	611/0
H	1851	1197/0	0/0	0/0	0/0	654/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/28	-91.8 -91.8 0.07 (1)	10.00	K-D	0/2959	0.28 (1)	
B-C	-3375/0	-91.8 -91.8 0.17 (1)	4.94	K-E	-150/0	0.03 (1)	
C-D	-3654/0	-91.8 -91.8 0.17 (1)	4.78	L-E	-301/0	0.03 (1)	
D-E	-3653/0	-91.8 -91.8 0.17 (1)	4.79	C-K	0/271	0.03 (1)	
E-F	-3758/0	-91.8 -91.8 0.17 (1)	4.72	L-C	-721/0	0.07 (1)	
F-G	0/28	-91.8 -91.8 0.07 (1)	10.00	B-L	0/3084	0.38 (1)	
M-B	-2354/0	0.0 0.0 0.08 (1)	7.81	I-F	0/3431	0.42 (1)	
H-F	-2590/0	0.0 0.0 0.09 (1)	7.81				
M-L	0/0	-18.5 -18.5 0.08 (1)	10.00				
L-K	0/3033	-18.5 -18.5 0.39 (1)	10.00				
K-N	0/3375	-18.5 -18.5 0.50 (1)	10.00				
N-J	0/3375	-18.5 -18.5 0.50 (1)	10.00				
J-I	0/3375	-18.5 -18.5 0.50 (1)	10.00				
I-H	0/0	-18.5 -18.5 0.03 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	
N	8-8	-2992	-2992		FRONT	VERT	

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.55")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.55")
CALCULATED VERT. DEFL.(TL) = L/999 (0.10")

CSI: TC=0.17/1.00 (E-F:1), BC=0.50/1.00 (I-K:1),
WB=0.42/1.00 (F-I:1), SSI=0.93/1.00 (I-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.84 (9) (INPUT = 0.90)
JSI METAL = 0.52 (1) (INPUT = 1.00)



Structural component only
DWG# T-2007043 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408133	T37	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 10:35:51 2020 Page 2
ID:DMCubINVR6TstFoe31v6I_zns1l-qZ2dwtW6se49lpbhblu36Dsi0911vKZnO2medzNDAs


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	2.00	3.00
C	TMWW-I	MT20	4.0	4.0	2.00	1.75
D	ITW-p	MT20	4.0	6.0	Edge	
E	TMWW-I	MT20	4.0	4.0	2.00	1.75
F	TMVW-p	MT20	5.0	6.0	2.00	3.00
H	BMV1-p	MT20	3.0	6.0		
I	BMWW-I	MT20	5.0	6.0		
J	BS-I	MT20	5.0	6.0		
K	BMWW-I	MT20	7.0	12.0	4.25	6.00
L	BMWW-I	MT20	5.0	6.0		
M	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2007043 2/2




Structural component only
DWG# T-2007044



1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED


JSI GRIP= 0.84 (B) (INPUT = 0.90)
JSI METAL= 0.25 (H) (INPUT = 1.00)



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408133	T40	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 10:35:55 2020 Page 1
ID:DMCubINVR6TsiFoe31v6l_zns11-LH8m0x0A58V6N6MwRqqEyNW3dbLznX9h00_nOzNDAo

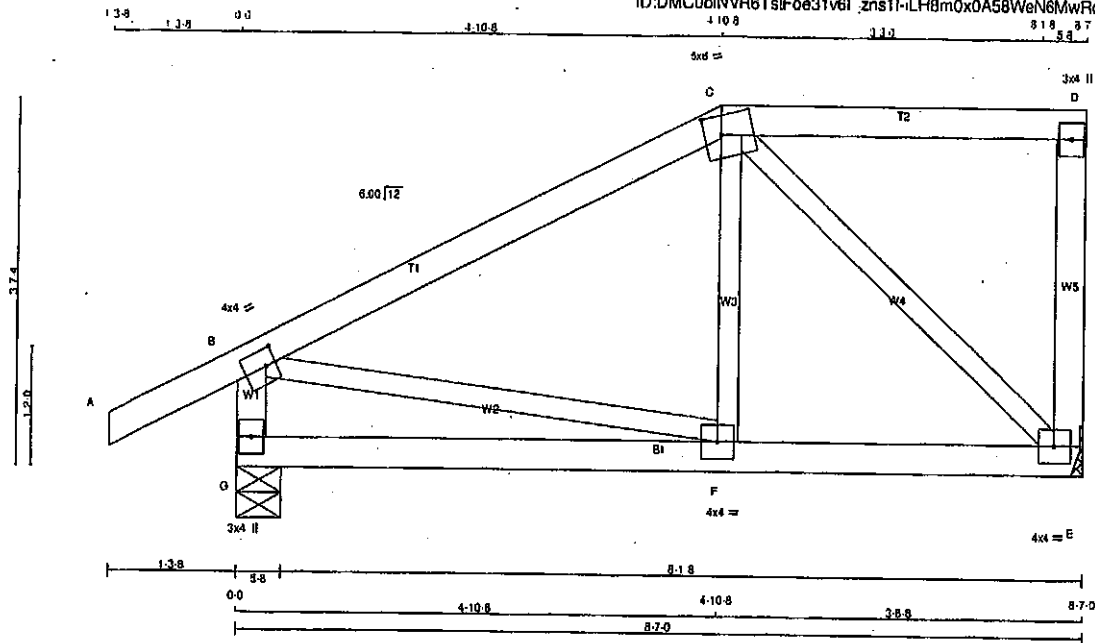

Scale = 1/2" = 1'-0"

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
G - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	4.0	2.00	1.25
C	TTWW-m	MT20	5.0	6.0	2.25	2.00
D	TMVW-p	MT20	3.0	4.0		
E	BMVW-1	MT20	4.0	4.0		
F	BMVW-1	MT20	4.0	4.0		
G	BMV-1p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
E	473	0	473	0	0	MECHANICAL
G	598	0	598	0	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	335	220 / 0	0 / 0	0 / 0	0 / 0	115 / 0	0 / 0
G	420	289 / 0	0 / 0	0 / 0	0 / 0	131 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. FACTORED CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	F-C	0 / 92	0.03 (4)
B-C	-350 / 0	-91.8	-91.8 0.28 (1)	8.25	G-E	-421 / 0	0.15 (1)
C-D	0 / 0	-91.8	-91.8 0.21 (1)	10.00	B-F	0 / 318	0.07 (1)
E-D	-170 / 0	0.0	0.0 0.03 (1)	7.81			
G-B	-559 / 0	0.0	0.0 0.06 (1)	7.81			
G-F	0 / 0	-18.5	-18.5 0.10 (4)	10.00			
F-E	0 / 315	-18.5	-18.5 0.13 (4)	10.00			

TOTAL WEIGHT = 36 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.29")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.28")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.02")

CSI: TC=0.28/1.00 (B-C:1), BC=0.13/1.00 (E-F:4), WB=0.16/1.00 (C-E:1), SS=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 798	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.57 (B) (INPUT = 0.90)
JSI METAL = 0.19 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007046

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408133	T41	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:35:56 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns1l-AXWzMexOGNGWWhYU8L3mAwjT1wyIEqIwgIXJqzNDAn

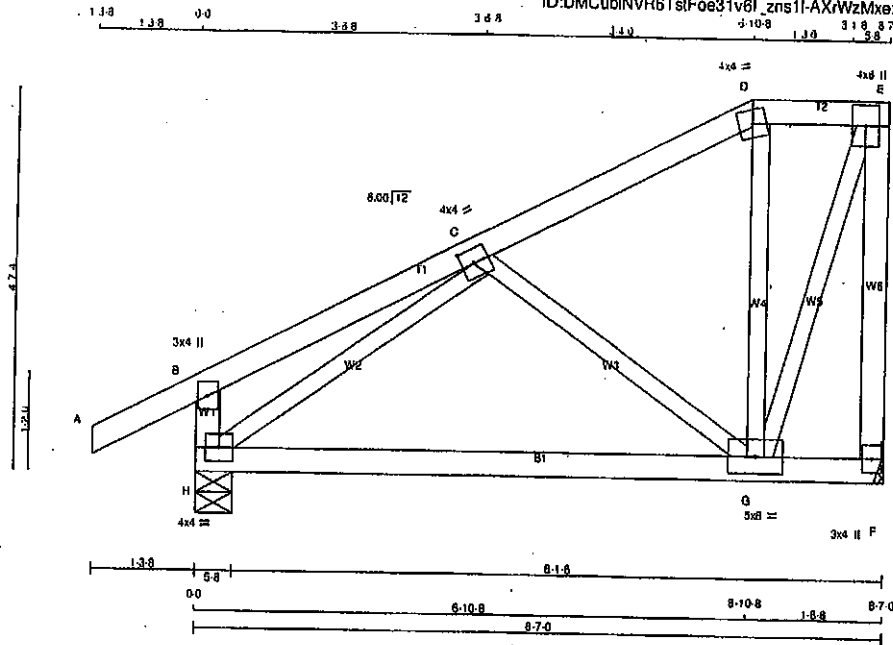

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-i	MT20	4.0	4.0	2.00	1.75
D	TTV-m	MT20	4.0	4.0		
E	TMVW+p	MT20	4.0	6.0		
F	BMV1+p	MT20	3.0	4.0		
G	BMWW-i	MT20	5.0	8.0		
H	BMVW1-i	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	473	0	473	0
H	598	0	598	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	335	220 / 0	0 / 0	0 / 0	0 / 0	0 / 0	115 / 0	0 / 0
H	420	289 / 0	0 / 0	0 / 0	0 / 0	0 / 0	131 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	VERT. LOAD	MAX. FACTORED	MEMB.	MAX. FACTORED	VERT. LOAD	MAX. FACTORED
	(LBS)	(PLF)	(LBS)		(LBS)	(PLF)	(LBS)
FR-TO				FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	C-G	-292 / 0	0.09 (1)
B-C	0 / 15	-91.8	-91.8 0.17 (1)	10.00	G-D	-117 / 0	0.04 (1)
C-D	-199 / 0	-91.8	-91.8 0.13 (1)	6.25	G-E	0 / 480	0.10 (1)
D-E	-160 / 0	-91.8	-91.8 0.09 (1)	8.25	H-C	-498 / 0	0.15 (1)
F-E	-509 / 0	0.0	0.0 0.17 (1)	7.81			
H-B	-245 / 0	0.0	0.0 0.02 (1)	7.81			
H-G	0 / 399	-18.5	-18.5 0.23 (4)	10.00			
G-F	0 / 0	-18.5	-18.5 0.21 (4)	10.00			

TOTAL WEIGHT = 41 lb [M/F]

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
DL	=	8.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 8 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.29")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.29")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.07")

CSI: TC=0.17/1.00 (B-C:1), BC=0.23/1.00 (G-H:4), WB=0.15/1.00 (C-H:1), SS=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 785	1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.45 (G) (INPUT = 0.90)
JSI METAL = 0.15 (H) (INPUT = 1.00)

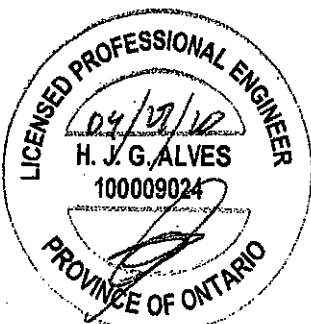

Structural component only
DWG# T-2007047





Structural component only
DWG# T-2007048

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Sat Apr 25 10:35:59 2020 Page 1
ID:DMCubINVR6TsiFos31v6l_zns11-b6WecO_XDJlx7_Q79HvmOoYApF_?vbAlca_Bw9zNDak



JSI GRIP= 0.80 (A) (INPUT = 0.90)
JSI METAL= 0.25 (A) (INPUT = 1.00)



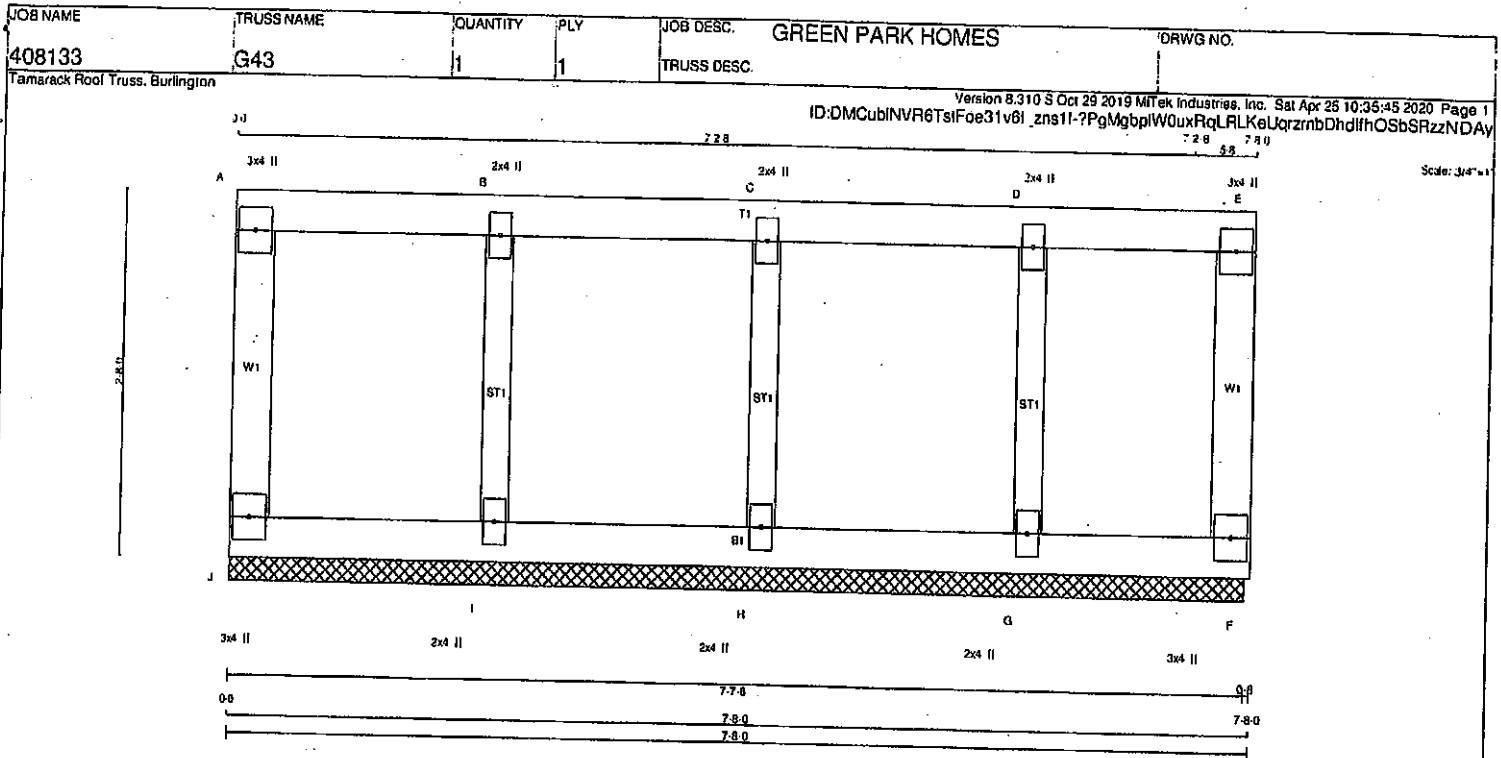

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
J - A	2x4	DRY	No.2
A - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
J - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2'-0" O.C.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A - TMV+p	MT20	3.0	4.0		
B, C, D					
B - TMV+w	MT20	2.0	4.0		
E - TMV+p	MT20	3.0	4.0		
F - BMV+p	MT20	3.0	4.0		
G, H, I					
G - BMV+w	MT20	2.0	4.0		
J - BMV+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING.

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
J-A	-102 / 0	0.0 0.0 0.03 (1)	7.81	I-B	-242 / 0	0.05 (1)	
A-B	-10 / 0	-114.3 -114.3 0.08 (1)	10.00	H-C	-229 / 0	0.05 (1)	
B-C	-10 / 0	-114.3 -114.3 0.08 (1)	10.00	G-D	-218 / 0	0.05 (1)	
C-D	-10 / 0	-114.3 -114.3 0.07 (1)	10.00				
D-E	-10 / 0	-114.3 -114.3 0.08 (1)	10.00				
E-F	-84 / 0	0.0 0.0 0.03 (1)	7.81				
J-I	0 / 10	-18.5 -18.5 0.02 (4)	10.00				
I-H	0 / 10	-18.5 -18.5 0.02 (4)	10.00				
H-G	0 / 10	-18.5 -18.5 0.02 (4)	10.00				
G-F	0 / 10	-18.5 -18.5 0.02 (4)	10.00				

TOTAL WEIGHT = 27 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 15.0 PSF

BOT CH. LL = 0.0 PSF
DL = 7.4 PSF

TOTAL LOAD = 48.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.08/1.00 (B-C:1), BC=0.02/1.00 (I-J:4), WB=0.05/1.00 (B-E:1), SS=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1897 788


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)
JSI METAL= 0.07 (I) (INPUT = 1.00)

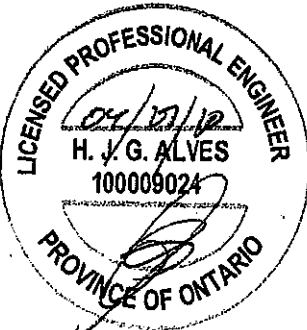

Structural component only
DWG# T-2007039

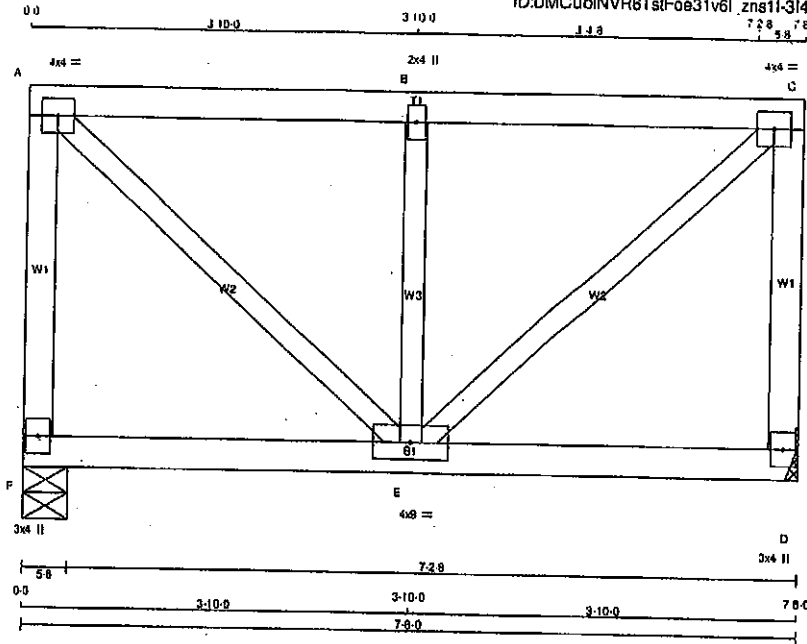

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
F - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	HORZ	DOWN	HORZ
F	509	0	5-8
D	509	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.8	PSF
	DL	= 15.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 48.0	PSF

SPACING = 24.0 IN. C/C

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	4.0	4.0		
B	TMVW-w	MT20	2.0	4.0		
C	TMVW-1	MT20	4.0	4.0		
D	BMV1+p	MT20	3.0	4.0		
E	BMVWW-1	MT20	4.0	9.0		
F	BMV1+p	MT20	3.0	4.0		

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL
F	368 198/0 0/0 0/0 0/0 172.0 0/0
D	368 198/0 0/0 0/0 0/0 172.0 0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CS1 (LC)	UNBRACED LENGTH
FR-TO				
F-A	-479/0	0.0	0.0	0.13 (1)
A-B	-354/0	-114.3	-114.3	0.38 (1)
B-C	-354/0	-114.3	-114.3	0.38 (1)
D-C	-479/0	0.0	0.0	0.13 (1)
F-E	0/0	-18.5	-18.5	0.09 (4)
E-D	0/0	-18.5	-18.5	0.09 (4)

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.28")

CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01")

ALLOWABLE DEFL. (TL) = $L/360$ (0.28")

CALCULATED VERT. DEFL. (TL) = $L/999$ (0.01")

CS1: $7C=0.38/1.00$ (B-C:1), $8C=0.09/1.00$ (E-F:4), $WB=0.16/1.00$ (B-E:1), $SSI=0.28/1.00$ (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR SECTION
(PSI)	(PLI) (PU)
MAX MIN	MAX MIN
MT20	618 354 1887 788 1987 1856


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.64 (C) (INPUT = 0.90)

JSI METAL = 0.18 (A) (INPUT = 1.00)



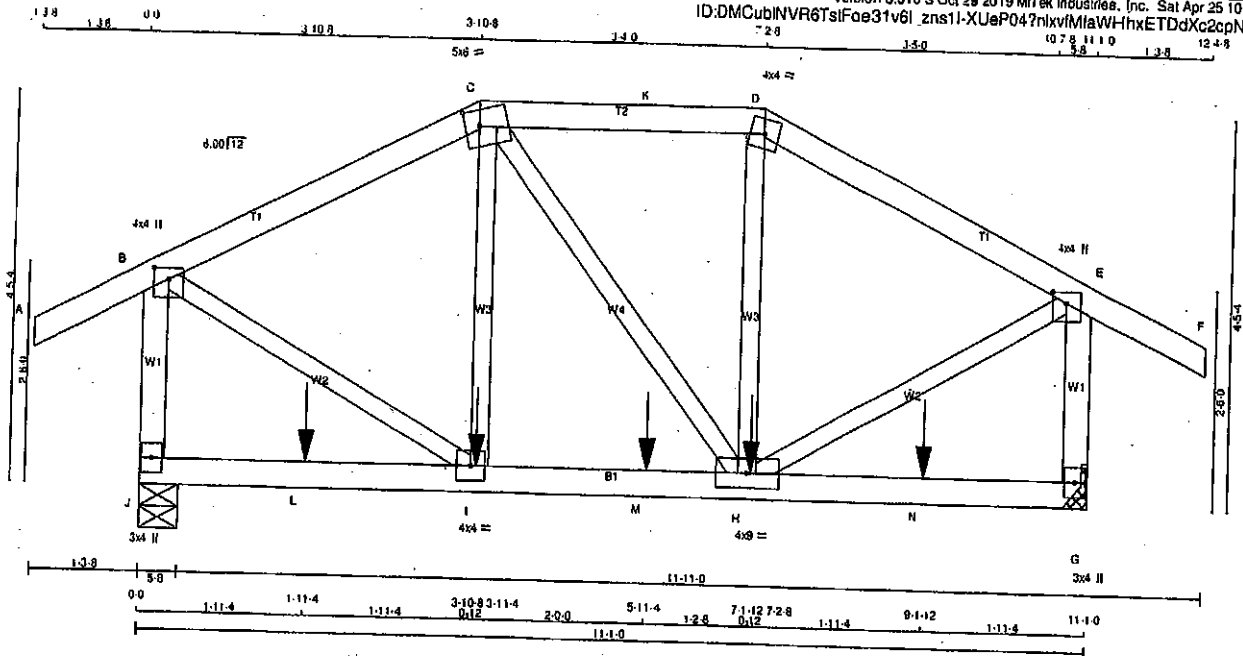

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
A - C	2x4	DRY No.2
C - D	2x4	DRY No.2
D - F	2x4	DRY No.2
F - G	2x4	DRY No.2
G - E	2x4	DRY No.2
E - J	2x4	DRY No.2

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.50	2.00
C	TTWW-m	MT20	5.0	6.0	2.25	2.00
D	TTW-m	MT20	4.0	4.0		
E	TMVW+p	MT20	4.0	4.0	1.50	2.00
G	BMV1+p	MT20	3.0	4.0		
H	BMVWW-I	MT20	4.0	9.0		
I	BMVWW-I	MT20	4.0	4.0		
J	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	UP	MECHANICAL
J	1205	0	0	5-8
G	1218	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED							
J	845	592 / 0	0 / 0	0 / 0	0 / 0	253 / 0	0 / 0	0 / 0
G	855	599 / 0	0 / 0	0 / 0	0 / 0	258 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 28	-91.8 -91.8	0.13 (1)	1-C	0 / 51	0.02 (4)	
B-C	-844 / 0	-91.8 -91.8	0.28 (1)	C-H	0 / 25	0.01 (1)	
C-K	-771 / 0	-91.8 -91.8	0.20 (1)	H-D	0 / 59	0.02 (4)	
K-D	-771 / 0	-91.8 -91.8	0.20 (1)	D-E	0 / 59	0.02 (4)	
D-E	-861 / 0	-91.8 -91.8	0.28 (1)	E-F	0 / 28	0.02 (4)	
E-F	0 / 28	-91.8 -91.8	0.13 (1)	F-G	-1088 / 0	0.00	0.15 (1)
F-G	-1088 / 0	0.00	0.15 (1)	G-H	-1112 / 0	0.00	0.16 (1)
G-H	-1112 / 0	0.00	0.16 (1)	H-I	0 / 0	-18.5	-18.5
H-I	0 / 0	-18.5	-18.5	I-J	0 / 0	-18.5	-18.5
I-J	0 / 0	-18.5	-18.5	J-K	0 / 755	-18.5	-18.5
J-K	0 / 755	-18.5	-18.5	K-L	0 / 755	-18.5	-18.5
K-L	0 / 755	-18.5	-18.5	L-M	0 / 0	-18.5	-18.5
L-M	0 / 0	-18.5	-18.5	M-N	0 / 0	-18.5	-18.5
M-N	0 / 0	-18.5	-18.5	N-O	0 / 0	-18.5	-18.5
N-O	0 / 0	-18.5	-18.5				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
H	7-1-12	-187	-187	---	BACK	VERT	TOTAL	---	C1
I	3-11-4	-187	-187	---	BACK	VERT	TOTAL	---	C1
L	1-11-4	-195	-195	---	BACK	VERT	TOTAL	---	C1
M	5-11-4	-187	-187	---	BACK	VERT	TOTAL	---	C1
N	9-1-12	-195	-195	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 51 LB [M]

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.37")
CALCULATED VERT. DEFL. (LL) = L/999 (0.03")
ALLOWABLE DEFL. (TL) = L/360 (0.37")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSI: TC=0.28/1.00 (D-E:1), BC=0.32/1.00 (H-I:1), WB=0.22/1.00 (E-H:1), SSI=0.14/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (I) (INPUT = 0.90)
JSI METAL = 0.28 (I) (INPUT = 1.00)

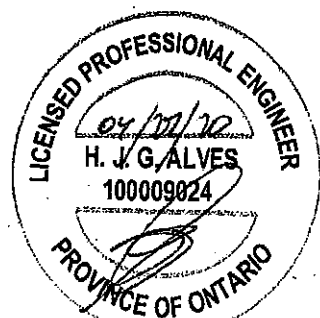

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408133	T46	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:38:02 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-7hCnEP0PWE1W_R9iqPST0RAwS_U6zFBibCsXUzNDAn

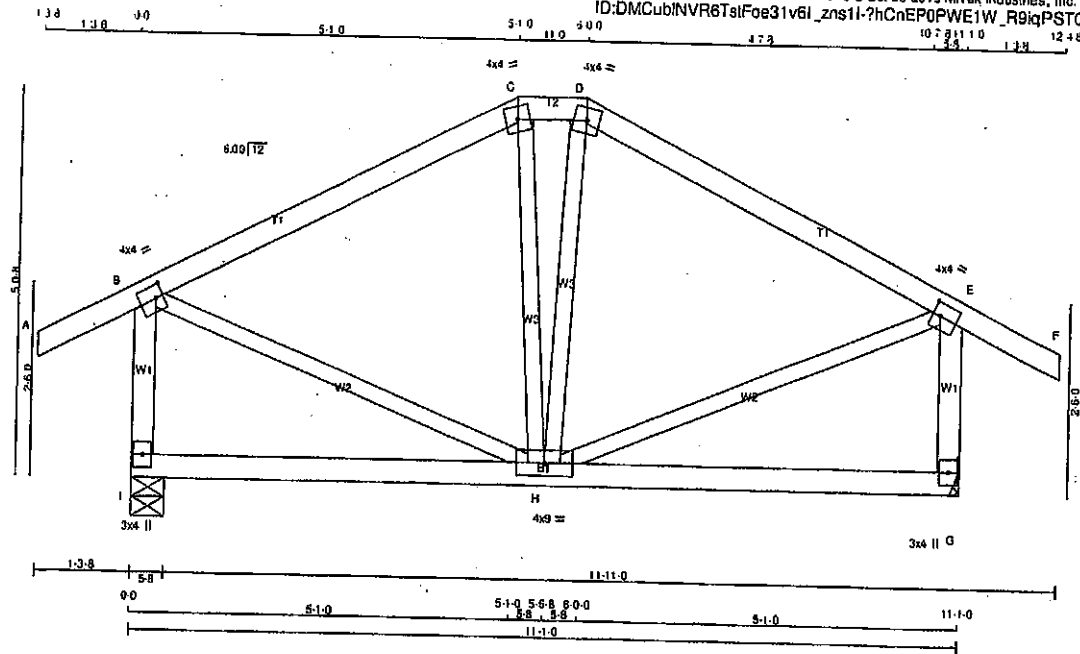

Scale = 1/8" = 1'-0"

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
		A - C	2x4	DRY	No.2	SPF
		C - D	2x4	DRY	No.2	SPF
		D - F	2x4	DRY	No.2	SPF
		I - B	2x4	DRY	No.2	SPF
		G - E	2x4	DRY	No.2	SPF
		I - G	2x4	DRY	No.2	SPF
		ALL WEBS	2x3	DRY	No.2	SPF
		EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
	B	TMVW-1	MT20	4.0	4.0	2.00 1.25
	C	TTW-m	MT20	4.0	4.0	
	D	TTW-m	MT20	4.0	4.0	
	E	TMVW-1	MT20	4.0	4.0	2.00 1.25
	G	BMV1+p	MT20	3.0	4.0	
	H	BMVWW-1	MT20	4.0	9.0	
	I	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	UP/LIFT	IN-SX
I	735	0	0	5-8
G	735	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
I	518	353 / 0	0 / 0	0 / 0	0 / 0	165 / 0	0 / 0
G	518	353 / 0	0 / 0	0 / 0	0 / 0	165 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LCI (LC)	MAX. UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO						FR-TO			
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	B-H	0 / 405	0.09 (1)	
B-C	-422 / 0	-91.8	-91.8	0.31 (1)	8.25	H-E	0 / 405	0.09 (1)	
C-D	-369 / 0	-91.8	-91.8	0.01 (1)	8.25	C-H	-88 / 18	0.03 (1)	
D-E	-422 / 0	-91.8	-91.8	0.31 (1)	8.25	H-D	-88 / 18	0.03 (1)	
E-F	0 / 28	-91.8	-91.8	0.12 (1)	10.00				
I-B	-895 / 0	0.0	0.0	0.09 (1)	7.81				
G-E	-895 / 0	0.0	0.0	0.09 (1)	7.81				
I-H	0 / 0	-18.5	-18.5	0.16 (4)	10.00				
H-G	0 / 0	-18.5	-18.5	0.16 (4)	10.00				

TOTAL WEIGHT = 51 lb

(MIF)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.8	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF	

SPACING = 24.0 IN.C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.37")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.37")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.31/1.00 (D-E:1), BC=0.16/1.00 (G-H:4), WB=0.09/1.00 (B-H:1), SS=0.16/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
	(PS)	(PL)	(PL)
	MAX	MIN	MAX MIN
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.84 (E) (INPUT = 0.90)
JSI METAL = 0.22 (E) (INPUT = 1.00)




Structural component only
DWG# T-2007052

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408133	T47S	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 MTek Industries, Inc. Sat Apr 25 10:38:04 2020 Page 1
ID:DMCubINVR6TstF0e31v6l_zns1l-x3KXl52g2sHEDl15yqUx5sF42GinavaUmvhycNzNDAr

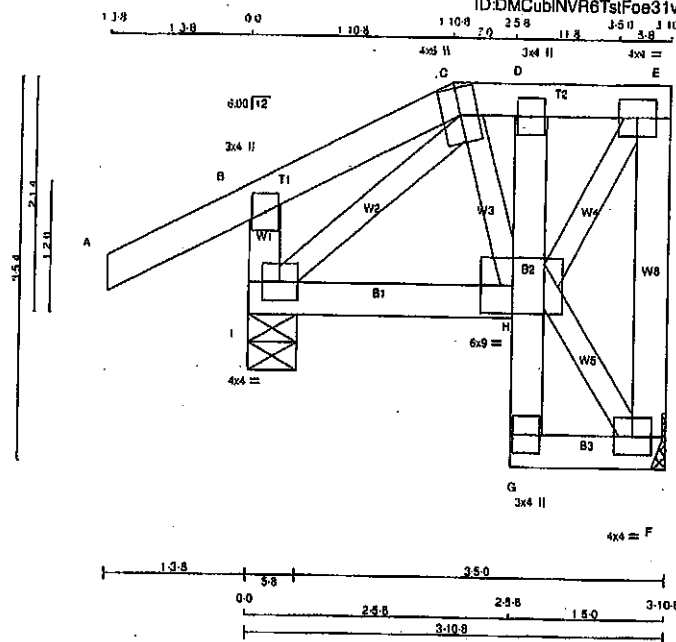

Scale = 1/19.8

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
I - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
G - D	2x4	DRY	No.2
G - F	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TTWW+m	MT20	4.0	6.0		
D	TMV+p	MT20	3.0	4.0		
E	TMV+p	MT20	4.0	4.0		
F	BMVW1-I	MT20	4.0	4.0		
G	BMV+p	MT20	3.0	4.0		
H	BMVWVW1-I	MT20	6.0	9.0	3.00	3.50
I	BMVW1-I	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT REQRD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX
F	214	0	214	0	0	0
I	338	0	338	0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
F	151	99/0	0/0	0/0	0/0	52/0	0/0
I	237	169/0	0/0	0/0	0/0	68/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/28	-91.8 -91.8	0.14 (5)	C-H	-13/7	0.00 (4)	
B-C	0/0	-91.8 -91.8	0.08 (1)	H-F	8/0	0.00 (1)	
C-D	-103/0	-91.8 -91.8	0.01 (1)	I-C	-148/0	0.03 (1)	
D-E	-99/0	-91.8 -91.8	0.02 (1)	H-E	0/172	0.04 (1)	
F-E	-198/0	0.0	0.04 (1)				
I-B	-212/0	0.0	0.02 (1)				
I-H	0/107	-18.5	-18.5 0.04 (4)				
G-H	0/13	0.0	0.0 0.01 (1)				
H-D	-98/0	0.0	0.0 0.01 (1)				
G-F	0/5	-18.5	-18.5 0.01 (4)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 24 = 48 lb [M]

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CSI: TC=0.14/1.00 (A-B:5), BC=0.04/1.00 (H-I:4), WB=0.04/1.00 (E-H:1), SS=0.10/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.21 (H) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)

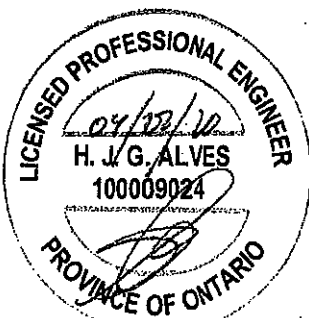

Structural component only
DWG# T-2007053


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408133	T50	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Sat Apr 25 10:38:05 2020 Page 2

ID:DMCubINVR8TsIFoe31v6I znsII-PGUwsR2lp9P5vtHWX?Ae3oA IyYJF6d7ZRW6ozNDAs

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
C	TTW-m	MT20	4.0	4.0		
D	TMVW+p	MT20	4.0	8.0		
E	BMV1+p	MT20	3.0	8.0		
F	BMWWW-1	MT20	6.0	9.0		
G	BMWW-1	MT20	5.0	6.0		
H	BMV1+p	MT20	3.0	8.0		

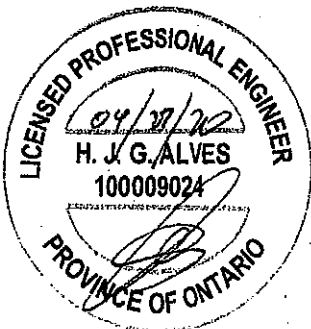


Structural component only
DWG# T-2007054 *2/2*

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408132	V20	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:24:30 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-GZOA?oeLUdry5FI41CzVWSIVqHzzuKXaEFbzNDLV

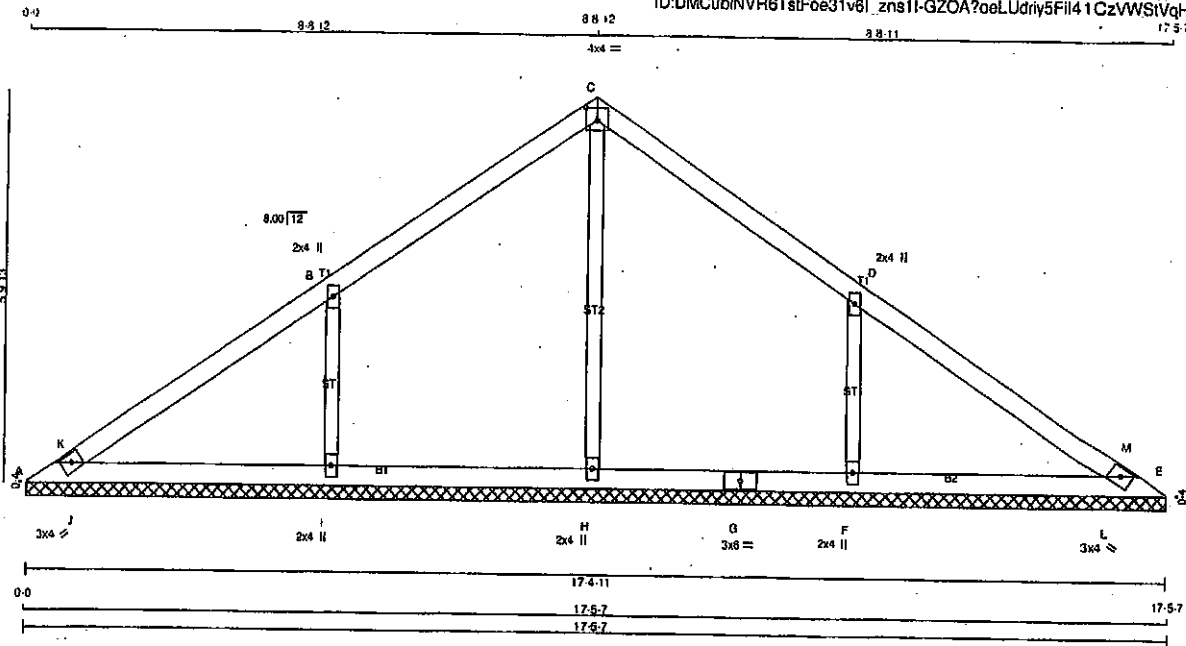

Scale = 1/32.0

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
A - G	2x4	DRY	No.2
G - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B	TMW-w	MT20	2.0	4.0		
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TMW-w	MT20	2.0	4.0		
E	TBM1-h	MT20	3.0	4.0		
F, H, I						
F	BMW1-w	MT20	2.0	4.0		
G	BS-t	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	UPLIFT	IN-SX
A	137	0	137	0
E	137	0	137	0
H	482	0	482	0
I	580	0	580	0
F	580	0	580	0

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	97	68 / 0	0 / 0	0 / 0	0 / 0	30 / 0	0 / 0
E	97	68 / 0	0 / 0	0 / 0	0 / 0	30 / 0	0 / 0
H	344	211 / 0	0 / 0	0 / 0	0 / 0	133 / 0	0 / 0
I	410	273 / 0	0 / 0	0 / 0	0 / 0	137 / 0	0 / 0
F	410	273 / 0	0 / 0	0 / 0	0 / 0	137 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, H, I, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-K	0 / 109	-91.8 -91.8 0.05 (4)	10.00	H-C	-439 / 0	0.22 (1)	
K-B	0 / 158	-91.8 -91.8 0.28 (1)	10.00	I-B	-453 / 0	0.08 (1)	
B-C	0 / 116	-91.8 -91.8 0.28 (1)	10.00	F-D	-453 / 0	0.08 (1)	
C-D	0 / 116	-91.8 -91.8 0.28 (1)	10.00	J-K	-122 / 8	0.00 (1)	
D-M	0 / 158	-91.8 -91.8 0.28 (1)	10.00	L-M	-122 / 8	0.00 (1)	
M-E	0 / 109	-91.8 -91.8 0.05 (4)	10.00				
A-J	-126 / 0	-18.5 -18.5 0.12 (1)	8.25				
J-I	-105 / 0	-18.5 -18.5 0.12 (1)	8.25				
I-H	-118 / 0	-18.5 -18.5 0.09 (1)	8.25				
H-G	-118 / 0	-18.5 -18.5 0.09 (1)	8.25				
G-F	-118 / 0	-18.5 -18.5 0.09 (1)	8.25				
F-L	-105 / 0	-18.5 -18.5 0.12 (1)	8.25				
L-E	-128 / 0	-18.5 -18.5 0.12 (1)	8.25				

TOTAL WEIGHT = 51 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.28/1.00 (B-K:1), BC=0.12/1.00 (I-J:1), WB=0.22/1.00 (C-H:1), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788 1987 1856

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.40 (D) (INPUT = 0.90)
JSI METAL= 0.23 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007033

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408132	V21	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 10:24:31 2020 Page 1
ID:DMCubINVR6TstFoe31v6l zns11-klyZCBzfFwzZaFqvsnzRWj2envAQISSUPbJnn1zNDLU

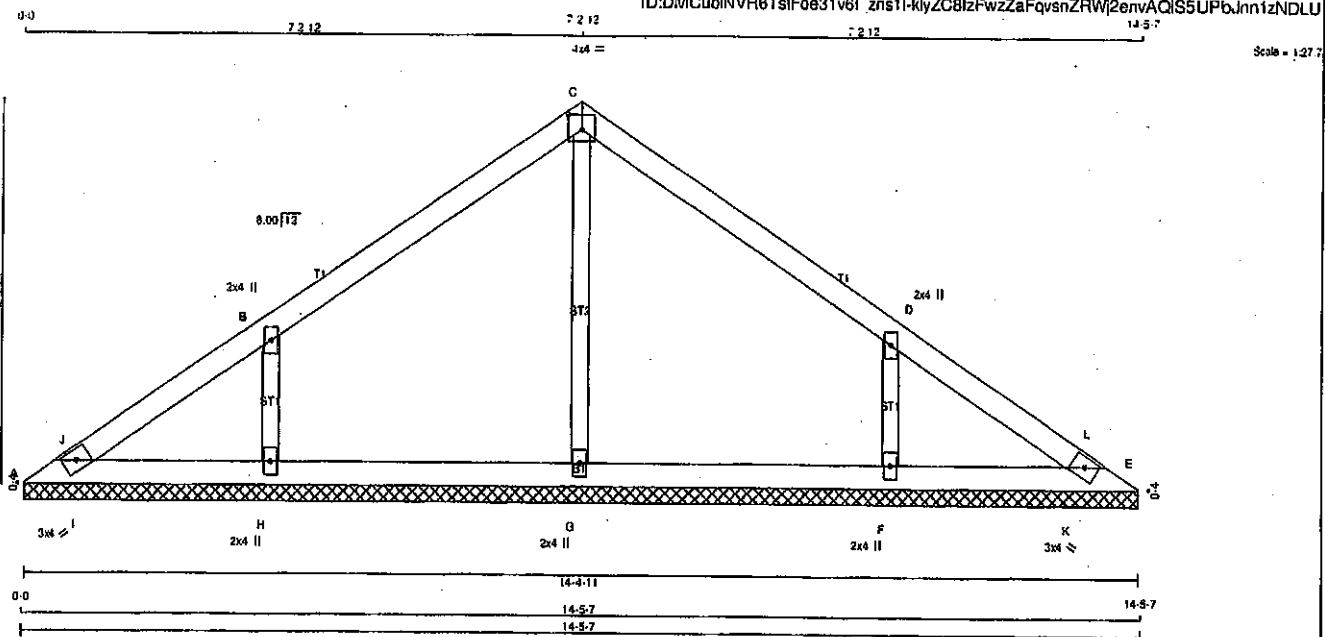

TOTAL WEIGHT = 41 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
A - E	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TBM1-h	MT20	3.0	4.0	
B	TTW-w	MT20	2.0	4.0	
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TTW-w	MT20	2.0	4.0	
E	TBM1-h	MT20	3.0	4.0	
F, G, H					
F	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	BRG	IN-SX	BRG	IN-SX
A	128	0	128	0	0	14-4-11	14-4-11		
E	128	0	128	0	0	14-4-11	14-4-11		
G	381	0	381	0	0	14-4-11	14-4-11		
H	485	0	485	0	0	14-4-11	14-4-11		
F	485	0	485	0	0	14-4-11	14-4-11		

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
A	90	62 / 0	0 / 0	0 / 0	0 / 0
E	90	62 / 0	0 / 0	0 / 0	0 / 0
G	259	153 / 0	0 / 0	0 / 0	0 / 0
H	342	230 / 0	0 / 0	0 / 0	0 / 0
F	342	230 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, G, H, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD	LC1 MAX (PLF)	CS1 (LC)	MEMB.	MAX. FORCE (LBS)	MAX. CS1 (LC)
FR-TO					FR-TO		
A-J	-44 / 0	-91.8	-91.8	0.04 (1)	G-C	-292 / 0	0.10 (1)
J-B	0 / 15	-91.8	-91.8	0.21 (1)	H-B	-399 / 0	0.08 (1)
B-C	-28 / 4	-91.8	-91.8	0.21 (1)	F-D	-399 / 0	0.08 (1)
C-D	-28 / 4	-91.8	-91.8	0.21 (1)	I-J	-28 / 7	0.00 (1)
D-L	0 / 15	-91.8	-91.8	0.21 (1)	K-L	-28 / 7	0.00 (1)
L-E	-44 / 0	-91.8	-91.8	0.04 (1)			
A-I	-5 / 18	-18.5	-18.5	0.04 (1)			
I-H	-3 / 24	-18.5	-18.5	0.05 (4)			
H-G	-7 / 6	-18.5	-18.5	0.08 (4)			
G-F	-7 / 6	-18.5	-18.5	0.08 (4)			
F-K	-3 / 24	-18.5	-18.5	0.05 (4)			
K-E	-5 / 18	-18.5	-18.5	0.04 (1)			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.21/1.00 (B-J:1), BC=0.06/1.00 (G-H:4), WB=0.10/1.00 (C-G:1), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.27 (D) (INPUT = 0.90)
JSI METAL= 0.20 (B) (INPUT = 1.00)

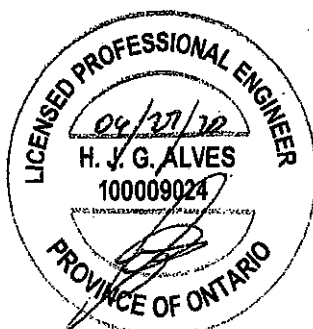


Structural component only
DWG# T-2007034

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408132	V22	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 10:24:32 2020 Page 1
ID:DMCubINVR6TstFae31v8l zns1l-CxWxQUgb0ESQCPP5PV4g2wbmgJTdRsCdeF3LJUZNDLT

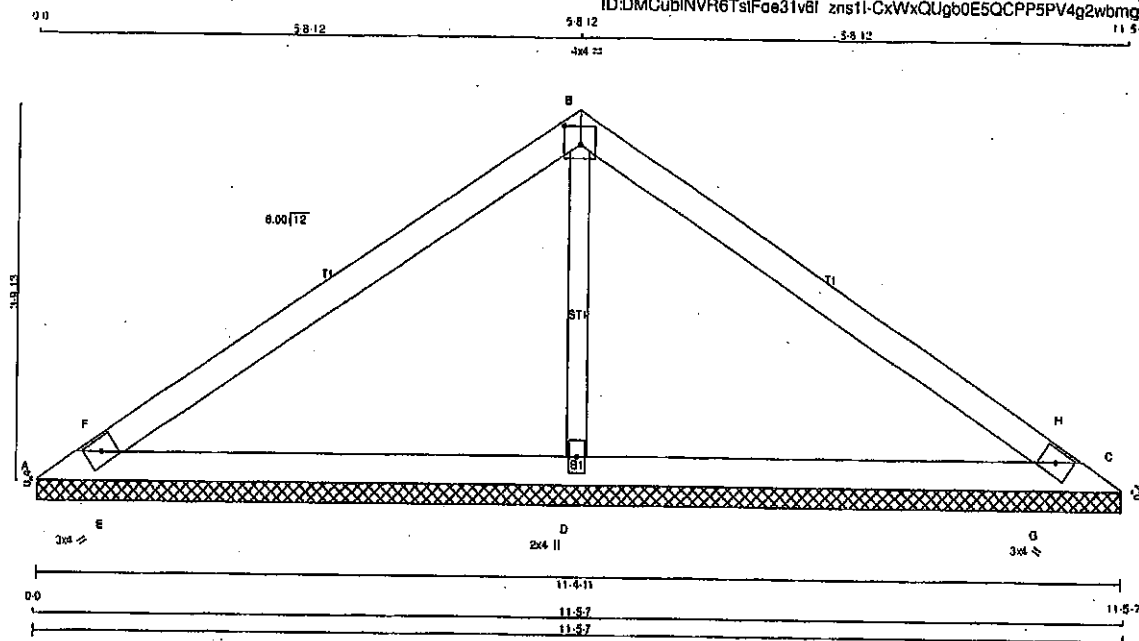

TOTAL WEIGHT = 30 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - B	No.2	2x4	DRY	No.2	SPF	
B - C	No.2	2x4	DRY	No.2	SPF	
A - C	No.2	2x4	DRY	No.2	SPF	
ALL WEBS	No.2	2x3	DRY	No.2	SPF	
						DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
	VERT	HORZ	IN-SX	IN-SX
A	-11	0	0	-11
C	-11	0	0	-11
D	1277	0	1277	0

PROVIDE ANCHORAGE AT BEARING JOINT A FOR 150 LBS FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

1ST CASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
A	-7	0/-7	0/0	0/0	0/0
C	-7	0/-7	0/0	0/0	0/0
D	902	597/0	0/0	0/0	305/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	W E B S	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LG1 (PLF)	MAX. MAX. UNBRACED LENGTH FR-TO	FORCE (LBS)
FR-TO				
A-F	0/591	-91.8 -91.8 0.25 (1)	10.00	D-B -1043/0 0.23 (1)
F-B	0/584	-91.8 -91.8 0.39 (1)	10.00	E-F -332/0 0.00 (1)
B-H	0/584	-91.8 -91.8 0.39 (1)	10.00	G-H -332/0 0.00 (1)
H-C	0/591	-91.8 -91.8 0.25 (1)	10.00	
A-E	-528/0	-18.5 -18.5 0.25 (1)	6.25	
E-D	-490/0	-18.5 -18.5 0.25 (1)	6.25	
D-G	-490/0	-18.5 -18.5 0.25 (1)	6.25	
G-C	-528/0	-18.5 -18.5 0.25 (1)	6.25	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.39/1.00 (B-F:1), BC=0.25/1.00 (D-E:1), WB=0.23/1.00 (B-D:1), SSI=0.18/1.00 (A-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 610 354 1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (B) (INPUT = 0.90)
JSI METAL = 0.30 (B) (INPUT = 1.00)

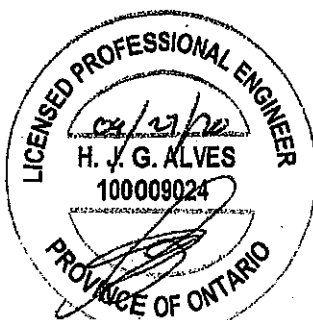

Structural component only
DWG# T-2007035

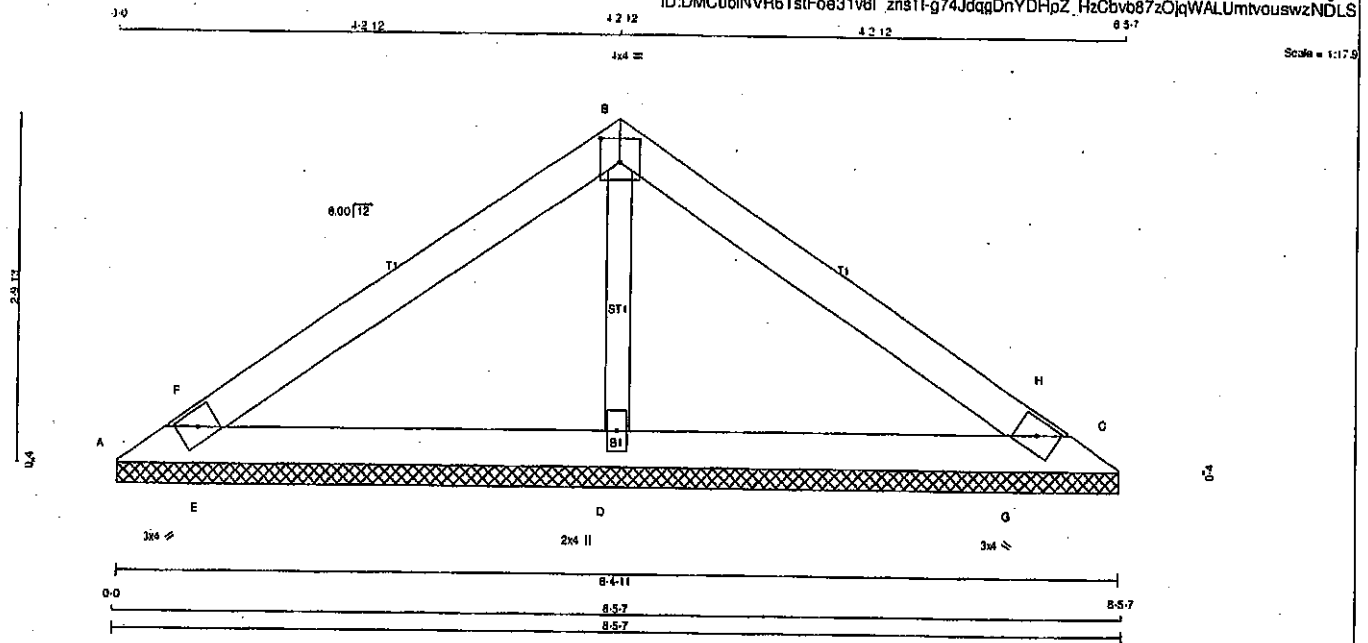

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF
B - C	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B	TTW-p	MT20	4.0	4.0	2.25	2.00
C	TBM1-h	MT20	3.0	4.0		
D	BMW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
A	58	0	58	0	8-4-11	8-4-11
C	58	0	58	0	8-4-11	8-4-11
D	808	0	808	0	8-4-11	8-4-11

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	41	27/0	0/0	0/0	0/0	14/0	0/0
C	41	27/0	0/0	0/0	0/0	14/0	0/0
D	572	375/0	0/0	0/0	0/0	198/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		MAX. FACTORED	
MEMB.	FORCE	VERT. LOAD	LC1 MAX	MAX.	MEMB.	FORCE	MAX
	(LBS)	(PLF)	CSI (LC)	UNBRACED		(LBS)	CSI (LC)
FR-TO		FROM TO		LENGTH	FR-TO		
A-F	0/297	-91.8 -91.8	0.10 (1)	10.00	D-B	-823/0	0.10 (1)
F-B	0/294	-91.8 -91.8	0.20 (1)	10.00	E-F	-202/0	0.00 (1)
B-H	0/294	-91.8 -91.8	0.20 (1)	10.00	G-H	-202/0	0.00 (1)
H-C	0/297	-91.8 -91.8	0.10 (1)	10.00			
A-E	-278/0	-18.5 -18.5	0.15 (1)	6.25			
E-D	-250/0	-18.5 -18.5	0.15 (1)	8.25			
D-G	-250/0	-18.5 -18.5	0.15 (1)	8.25			
G-C	-278/0	-18.5 -18.5	0.15 (1)	8.25			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.20/1.00 (B-F:1), BC=0.15/1.00 (D-E:1), WB=0.10/1.00 (B-D:1), SSI=0.11/1.00 (A-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1887 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.52 (B) (INPUT = 0.90)
JSI METAL = 0.18 (B) (INPUT = 1.00)

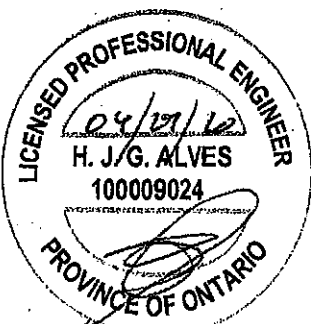

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408087	J1	21	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

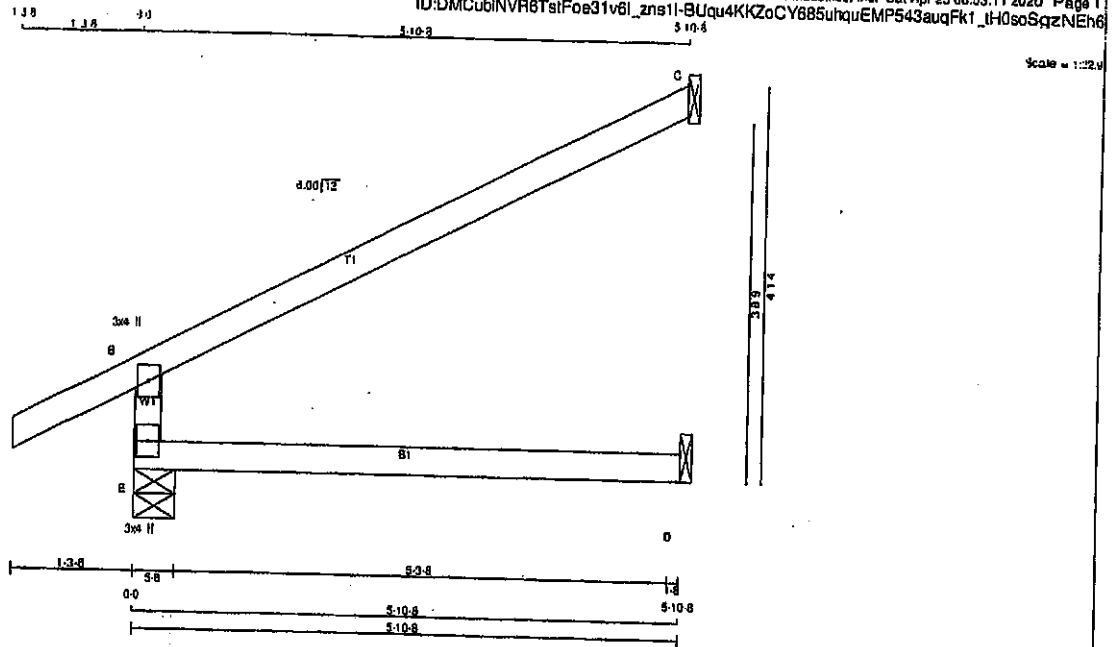

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	
CHORDS	2x4	DRY	No.2
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)				
JT TYPE	PLATES	W	LEN	Y
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECORD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	525	0	525	0	5-8	5-8
C	202	0	202	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT E C D.	1ST CASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
	389	257 / 0	0 / 0	0 / 0	0 / 0	111 / 0	0 / 0
	139	113 / 0	0 / 0	0 / 0	0 / 0	26 / 0	0 / 0
	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD		MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB. FORCE (LBS)	MAX. FACTORED CSI (LC)
		LC1 (PLF)	LC2 (PLF)				
FR-TO		FROM	TO			FR-TO	
E-B	-461 / 0	0.0	0.0	0.13 (4)	7.81		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00		
B-C	-30 / 0	-91.8	-91.8	0.54 (1)	6.25		
E-D	0 / 0	-18.5	-18.5	0.13 (4)	10.00		

TOTAL WEIGHT = 21 X 17 = 353 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (W:0), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PL)	SECTION (PL)
MAX	MIN	MAX
MT20	618	354

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (E) (INPUT = 0.90)
JSI METAL = 0.13 (B) (INPUT = 1.00)

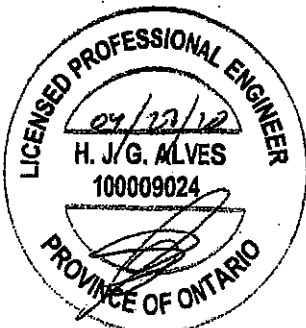


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408131	J2	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:07:18 2020 Page 1
ID:DMCubINVR6TstFoe31v61_zns11-U012Pw9?WXq88VMNkWB8Im65VcPAGiQINbd1PzNDbd

Scale = 1/2" = 1'-0"

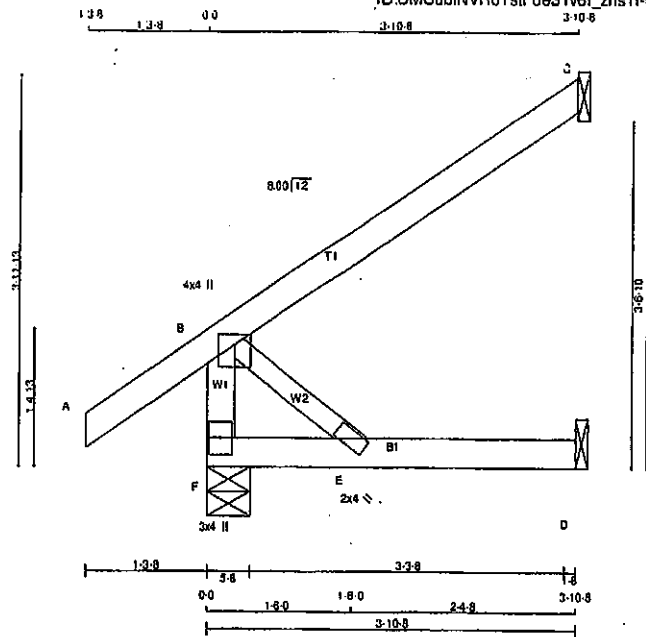

TOTAL WEIGHT = 4 X 14 = 57 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ORY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMW+p	MT20	4.0	4.0	1.25 2.00
E	BMW+w	MT20	2.0	4.0	
F	BMV+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	IN-SX	IN-SX	
F	340	0	340	0	0	5-8	5-8
C	178	0	178	0	0	1-8	1-8
D	38	0	40	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
JT	1ST LCASE	SNOW	LIVE	PERM LVE	WIND	DEAD	SOIL
F	238	169/0	0/0	0/0	0/0	68/0	0/0
C	122	99/0	0/0	0/0	0/0	23/0	0/0
D	29	0/0	0/0	0/0	0/0	29/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC1)	
FR-TO				FR-TO			
F-B	-304/0	0.0	0.0 0.03 (1)	7.81	B-E	0/0	0.00 (1)
A-B	0/35	-91.8	-91.8 0.14 (5)	10.00			
B-C	0/0	-91.8	-91.8 0.23 (1)	10.00			
F-E	0/0	-18.5	-18.5 0.08 (4)	10.00			
E-D	0/0	-18.5	-18.5 0.08 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.23/1.00 (B-C:1), BC=0.08/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 L3 BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007014

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408131	J3	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington


Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:07:20 2020 Page 1
ID:DMCubINVR6TslFoe31v6l_zns1l-QP9oqcAG294OpVlylZlDirTJJltaNjKh4j5lzNDbb

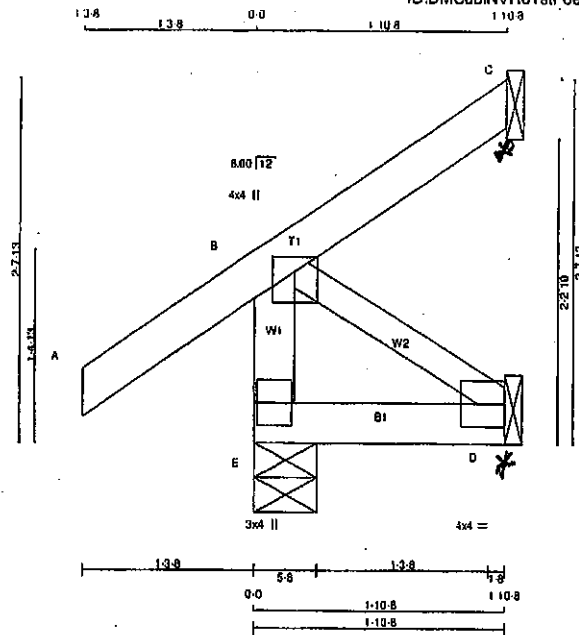

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408131	J4	10	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 10:07:21 2020 Page 1
ID:DMCubINVR6TsiFoe31v6I_zns11-ubjA1xBupSCi?z4xWT4umWOCVicmNddtZLpHdkzNDba

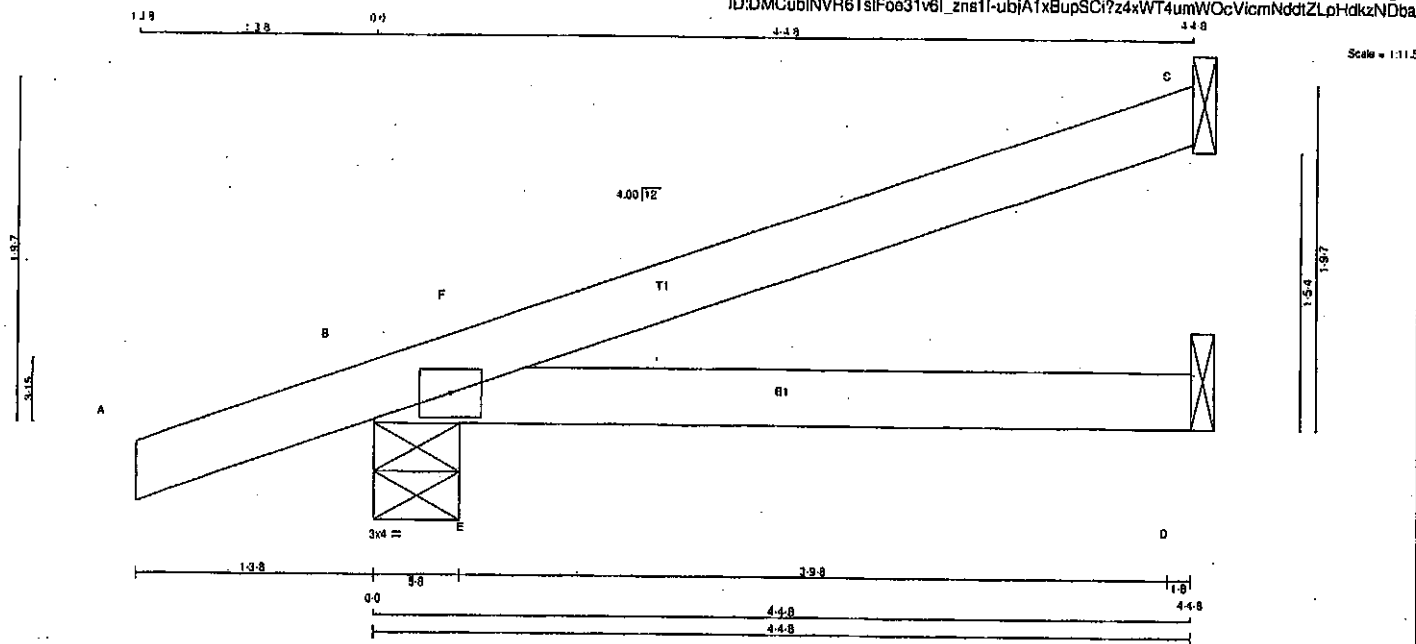

TOTAL WEIGHT = 10 X 12 = 119.5

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
B - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMS1-1	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
C	174	0	174	0	0	1-8	1-8
B	384	0	384	0	0	5-8	5-8
D	68	0	68	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
C	120	93/0	0/0	0/0	0/0	27/0	0/0
B	255	180/0	0/0	0/0	0/0	75/0	0/0
D	50	19/0	0/0	0/0	0/0	32/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO			FR-TO			
A-B	0/18	-91.8	-91.8	0.11 (1)	10.00	E-F	-194/7	
B-F	-14/0	-91.8	-91.8	0.05 (4)	6.25		0.00 (1)	
F-C	0/2	-91.8	-91.8	0.22 (1)	10.00			
B-E	0/0	-18.5	-18.5	0.17 (1)	10.00			
E-D	0/0	-18.5	-18.5	0.17 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.02")
ALLOWABLE DEFL. (TL) = $L/360$ (0.18")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.05")

CS1: TC=0.22/1.00 (C-F:1), BC=0.17/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SS1=0.18/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP (DRY) (PSI) (PLI)
SHEAR (PLI)
SECTION (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.24 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)

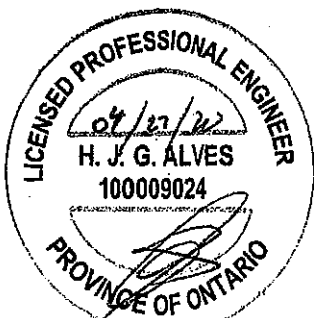


Structural component only
DWG# T-2007016

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408133	J30	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri May 8 12:53:48 2020 Page 1
ID:DMCubINVR6TsFoe31v6l_zns11-J6QNe3e7McJWaLKpv1nZJVMmex0A3P9W6lc7z1ZrX

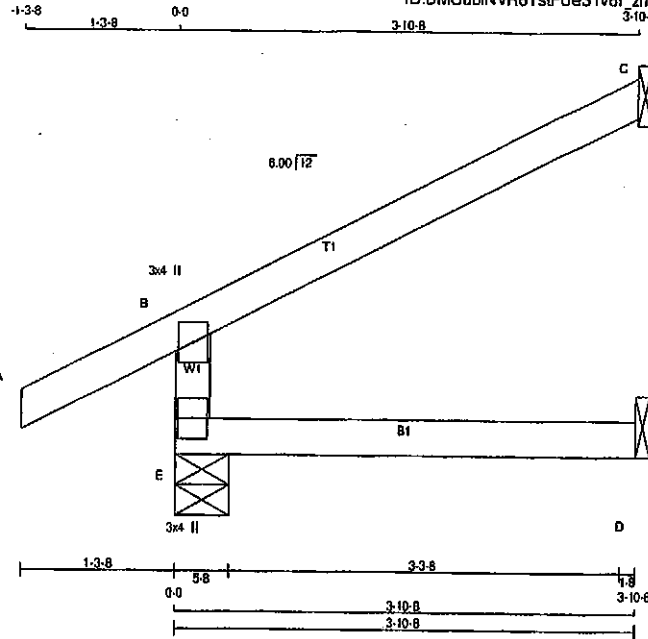

Scale = 1:18.1

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0			
E	BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ
E	388	0	388	0
C	133	0	133	0
D	30	0	34	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	272	193 / 0	0 / 0	0 / 0	0 / 0	0 / 0	78 / 0	0 / 0
C	92	74 / 0	0 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	24	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	24 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	VERT. LOAD LC1	MAX. FACTORED UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH
FR-TO									
E-B	-347	0	0.0	0.0	0.05 (4)	7.81			
A-B	0	28	-91.8	-91.8	0.14 (5)	10.00			
B-C	-20	0	-91.8	-91.8	0.23 (1)	8.25			
E-D	0	0	-18.5	-18.5	0.06 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 12 = 24 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSK: TC=0.23/1.00 (B-C:1), BC=0.08/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	618	354
	1867	788
	1987	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.15 (E) (INPUT = 0.90)
JSI METAL= 0.10 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008522

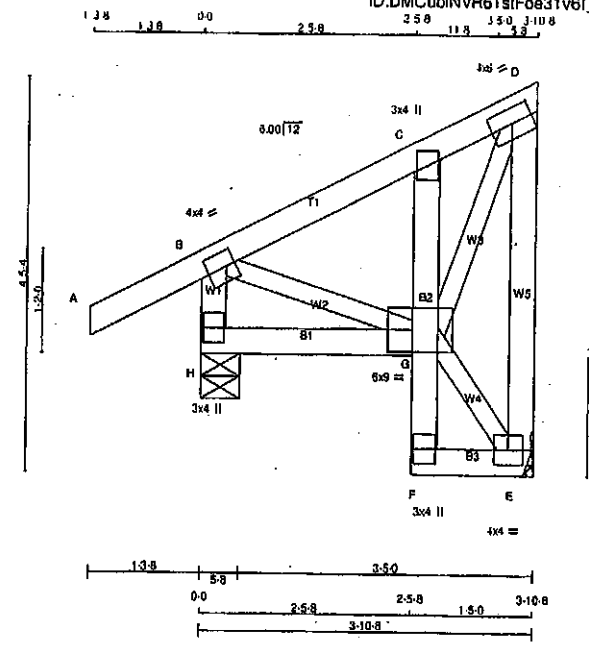

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
H - B	2x4	DRY	No.2	SPF
A - D	2x4	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF
F - C	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	4.0	2.00	1.25
C	TMVW-p	MT20	3.0	4.0		
D	TMVW-t	MT20	4.0	6.0	2.00	3.00
E	BMVW-1	MT20	4.0	4.0		
F	BMVW-p	MT20	3.0	4.0		
G	BMVW-t	MT20	6.0	9.0	3.00	3.50
H	BMV-1	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	IN-SX	IN-SX
H	330	0	5-8	5-8
E	208	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	231	165 / 0	0 / 0	0 / 0	0 / 0	66 / 0	0 / 0
E	145	95 / 0	0 / 0	0 / 0	0 / 0	50 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	MAX. FACTORED FORCE (LBS)	CHORDS		WEBS		MAX. FACTORED FORCE (LBS)	MAX. GSI (LC)
		VERT. LOAD (PLF)	LC1 MAX	UNBRAC LENGTH	FR-TO		
H-B	-308 / 0	0.0	0.0	0.03 (1)	7.81	B-G	0 / 105
A-B	0 / 28	-91.8	-91.8	0.13 (5)	10.00	E-D	-185 / 0
B-C	-104 / 0	-91.8	-91.8	0.07 (1)	6.25	G-E	-14 / 0
C-D	-114 / 0	-91.8	-91.8	0.06 (1)	6.25	G-D	0 / 229
H-G	0 / 0	-18.5	-18.5	0.04 (4)	10.00		
F-G	0 / 12	0.0	0.0	0.02 (1)	10.00		
G-C	-221 / 0	0.0	0.0	0.02 (1)	7.81		
F-E	0 / 9	-18.5	-18.5	0.01 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 25 = 75 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 OL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 OL = 7.4 PSF
 TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
 ALLOWABLE DEFL.(TL) = L/360 (0.19")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.13/1.00 (A-B-5), BC=0.04/1.00 (G-H-4),
 WB=0.05/1.00 (D-G-1), SSI=0.10/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN
MT20	618	354	1887	788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.19 (D) (INPUT = 0.90)
 JSI METAL= 0.08 (B) (INPUT = 1.00)



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408131	C1	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 10:07:16 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_znst1-XdvH_E7I7wZQvCC_jvUj3Shn3hwxiM8P36WyXzNDbl

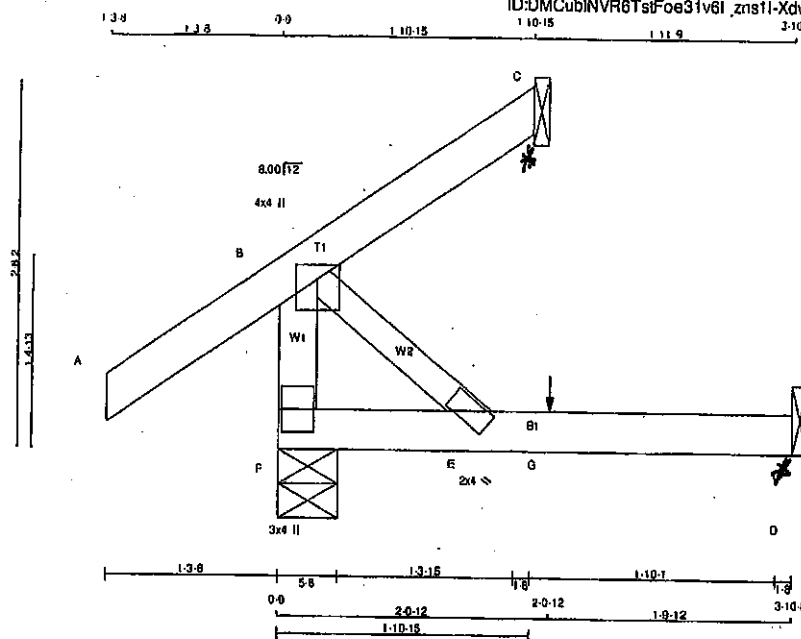

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DESCR.
SPF
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG	
	VERT	HORZ	DOWN	HORZ		IN-SX	IN-SX
F	295	0	295	0	5-8	5-8	
C	42	0	42	0	1-8	1-8	
D	36	0	40	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT G FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST CASE		MAX/MIN COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
F	207	144 / 0	0 / 0	0 / 0	0 / 0	83 / 0	0 / 0
C	29	24 / -25	0 / 0	0 / 0	0 / 0	8 / 0	0 / 0
D	29	0 / 0	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO	FR-TO	
F-B	-259 / 0	0.0 0.0 0.03 (1)	7.81	0 / 0
A-B	0 / 35	-91.8 -91.8 0.14 (5)	10.00	
B-C	-25 / 0	-91.8 -91.8 0.13 (5)	8.25	
F-E	0 / 0	-18.5 -18.5 0.08 (4)	10.00	
E-G	0 / 0	-18.5 -18.5 0.08 (4)	10.00	
G-D	0 / 0	-18.5 -18.5 0.08 (4)	10.00	

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
G	2-0-12	1	1	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 11 = 34 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL	6.0	PSF
BOT CH.	LL = 0.0	PSF
DL	7.4	PSF
TOTAL LOAD	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.01")

CSI: TC=0.14/1.00 (A-B-5), BC=0.08/1.00 (D-E-4), WB=0.00/1.00 (B-E-1), SS=0.09/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	518 354	1867 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007012

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408131	C2	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITAK Industries, Inc. Sat Apr 25 10:07:17 2020 Page 1
ID:DMCubINVR6TsPoe31vbl_zns11-?qTtBa8NEhHXLnAHd?yogDz45H8RpdHejr3UzzNDbe

Scale = 1/16" = 1'-0"

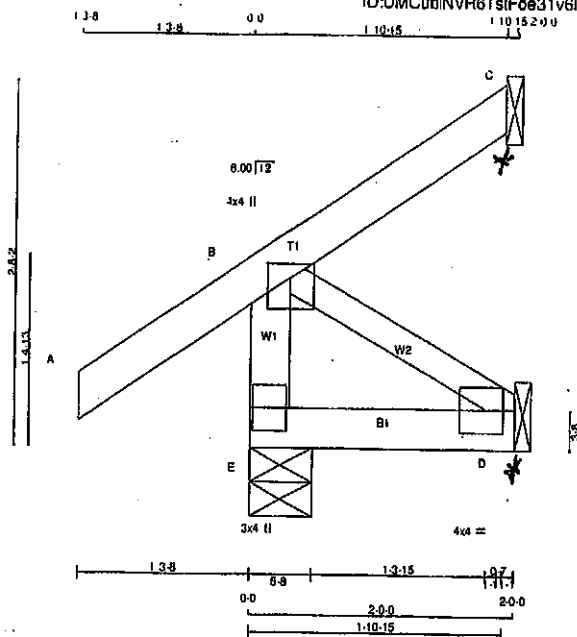

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
E - B	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
E - D	2x4 DRY	No.2	SPF
ALL WEBS 2x3 DRY			
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT		RECORD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	276	0	276	0	0	5-8	5-8
C	42	0	42	0	-35	1-8	1-8
D	18	0	20	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT G FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	192	144 / 0	0 / 0	0 / 0	0 / 0	0 / 0	48 / 0	0 / 0
C	29	24 / -25	0 / 0	0 / 0	0 / 0	0 / 0	6 / 0	0 / 0
D	14	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)	MAX. FACTORED	MAX
FR-TO		FROM	TO	FR-TO			
E-B	-259 / 0	0.0	0.0	0.03 (1)	7.81	B-D	0.0 (1)
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00		
B-C	-25 / 0	-91.8	-91.8	0.12 (1)	6.25		
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD				= 39.0 PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BOBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (TL) = L/360 (0.19")

CALCULATED VERT. DEFL. (TL) = L/999 (0.007)

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (B-D:1), SSI=0.09/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618	354
	1667	788
	1937	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)

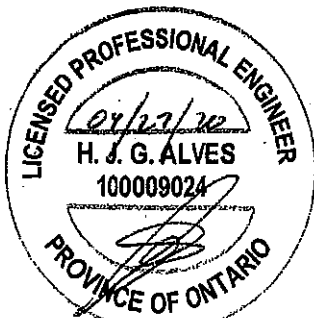

Structural component only
DWG# T-2007013

Scale = 1:13.3

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408133	C35	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

ID:DMCubINVR6TstFob31v6I_znstI-XD6_SG07lm4pgmFnd7FHeChpCburDX9orvXzNDAz

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 10:35:44 2020 Page 1

Scale = 1:13.4

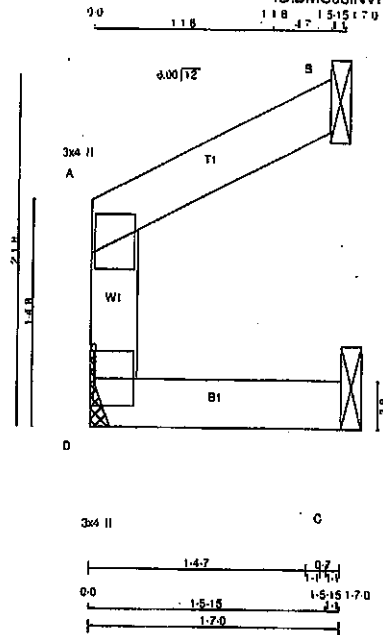

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
D - A	2x4	DRY	No.2	
A - B	2x4	DRY	No.2	
D - C	2x4	DRY	No.2	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0			
D	BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
D	83	83	0	0
B	65	65	0	0
C	18	18	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	59	38 / 0	0 / 0	0 / 0	0 / 0	0 / 0	21 / 0	0 / 0
B	45	38 / 0	0 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
C	14	2 / 0	0 / 0	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)	MAX. FACTORED VERT. LOAD (LC4)	MAX. FACTORED VERT. LOAD (LC5)	MAX. FACTORED VERT. LOAD (LC6)	MAX. FACTORED VERT. LOAD (LC7)	MAX. FACTORED VERT. LOAD (LC8)	MAX. FACTORED VERT. LOAD (LC9)	MAX. FACTORED VERT. LOAD (LC10)
FR-TO	D-A	-72 / 0	0.0	0.0	0.01 (1)	7.81							
	A-B	-2 / 0	-91.8	-91.8	0.03 (1)	10.00							
	D-C	0 / 0	-18.5	-18.5	0.01 (4)	10.00							

TOTAL WEIGHT = 5 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD.

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.03/1.00 (A-B:1), BC=0.01/1.00 (C-D:4), WB=0.00/1.00 (n/a:0), SSI=0.05/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788
	1907	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.08 (D) (INPUT = 0.90)
JSI METAL= 0.02 (A) (INPUT = 1.00)




Structural component only
DWG# T-2007038

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408268	T32	2	1	TRUSS DESC.		

Tamarrack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:54:33 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns11-5gB7FpkCjvDMQeWnoWbrsdwD7WQB2ovGsm8dzMEVa

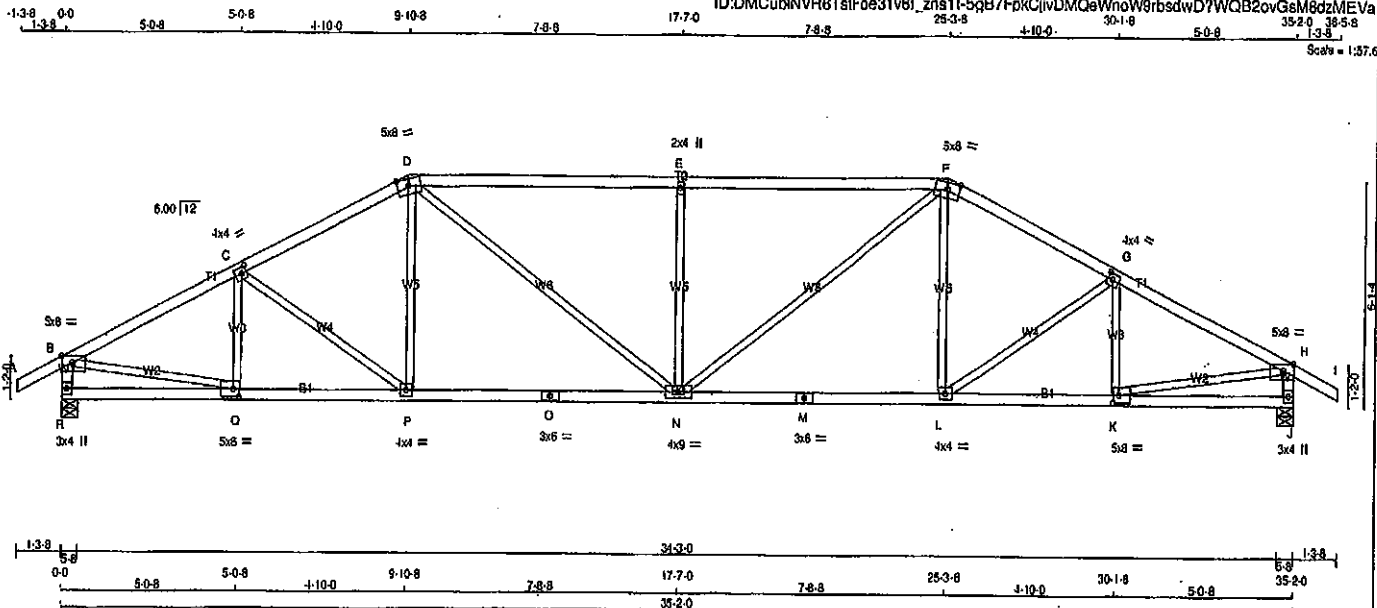

LUMBER	N.L.G.A. RULES	SIZE	LUMBER	DESCR.
CHORDS				
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
I - B	2x4	DRY	No.2	SPF
B - H	2x4	DRY	No.2	SPF
H - O	2x4	DRY	No.2	SPF
O - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50	
C	TMVW-t	MT20	4.0	4.0	2.00	1.75	
D	TTWW-m	MT20	5.0	8.0	2.25	3.75	
E	TMVW-w	MT20	2.0	4.0			
F	TTWW-m	MT20	5.0	8.0	2.25	3.75	
G	TMVW-t	MT20	4.0	4.0	2.00	1.75	
H	TMVW-p	MT20	5.0	8.0	Edge	3.50	
J	BMV1-p	MT20	3.0	4.0			
K	BMVW-t	MT20	5.0	8.0	2.50	2.00	
L	BMVW-t	MT20	4.0	4.0			
M	BS-t	MT20	3.0	6.0			
N	BMVW-w	MT20	4.0	9.0			
O	BS-t	MT20	3.0	6.0			
P	BMVW-t	MT20	4.0	4.0			
Q	BMVW-t	MT20	5.0	8.0	2.50	2.00	
R	BMV1-p	MT20	3.0	4.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
R	2063	0	2063	0	5-8
J	2063	0	2063	0	5-8

UNFACTORED REACTIONS		1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE	PERM LIVE
R	1457	989 / 0	0 / 0	0 / 0
J	1457	989 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2'8" FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED	MEMB.	MAX. FACTORED
	FORCE (LBS)		FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	0 / 28	C-C	-353 / 0
B-C	-2834 / 0	D-D	-210 / 0
C-D	-2887 / 0	E-E	-246 / 0
D-E	-3080 / 0	F-F	-246 / 0
E-F	-3080 / 0	G-G	-246 / 0
F-G	-2887 / 0	H-H	-210 / 0
G-H	-2834 / 0	I-I	-353 / 0
H-I	0 / 28	J-J	0 / 2591
I-J	-2018 / 0	K-K	0 / 2591
J-K	-2018 / 0	L-L	0 / 2591
K-L	0 / 0	M-M	0 / 2591
L-M	0 / 0	N-N	0 / 2591
M-N	0 / 0	O-O	0 / 2591
N-O	0 / 0	P-P	0 / 2591
O-P	0 / 0	Q-Q	0 / 2591
P-Q	0 / 0	R-R	0 / 2591
Q-R	0 / 0	S-S	0 / 2591
R-S	0 / 0	T-T	0 / 2591
S-T	0 / 0	U-U	0 / 2591
T-U	0 / 0	V-V	0 / 2591
U-V	0 / 0	W-W	0 / 2591
V-W	0 / 0	X-X	0 / 2591
W-X	0 / 0	Y-Y	0 / 2591
X-Y	0 / 0	Z-Z	0 / 2591
Y-Z	0 / 0		
Z	0 / 0		

TOTAL WEIGHT = 2 X 139 = 277 lb

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.17')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.34')

CSI: TC=0.97/1.00 (D-E); BC=0.51/1.00 (K-L); WB=0.58/1.00 (H-K); SS=0.34/1.00 (D-E);

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	
PLATE GRIP (DRY)	SHEAR SECTION
(PSI)	(PLI)
MAX MIN	MAX MIN
MT20	818 354 1687 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (D) (INPUT = 0.80)

JSI METAL = 0.82 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007716

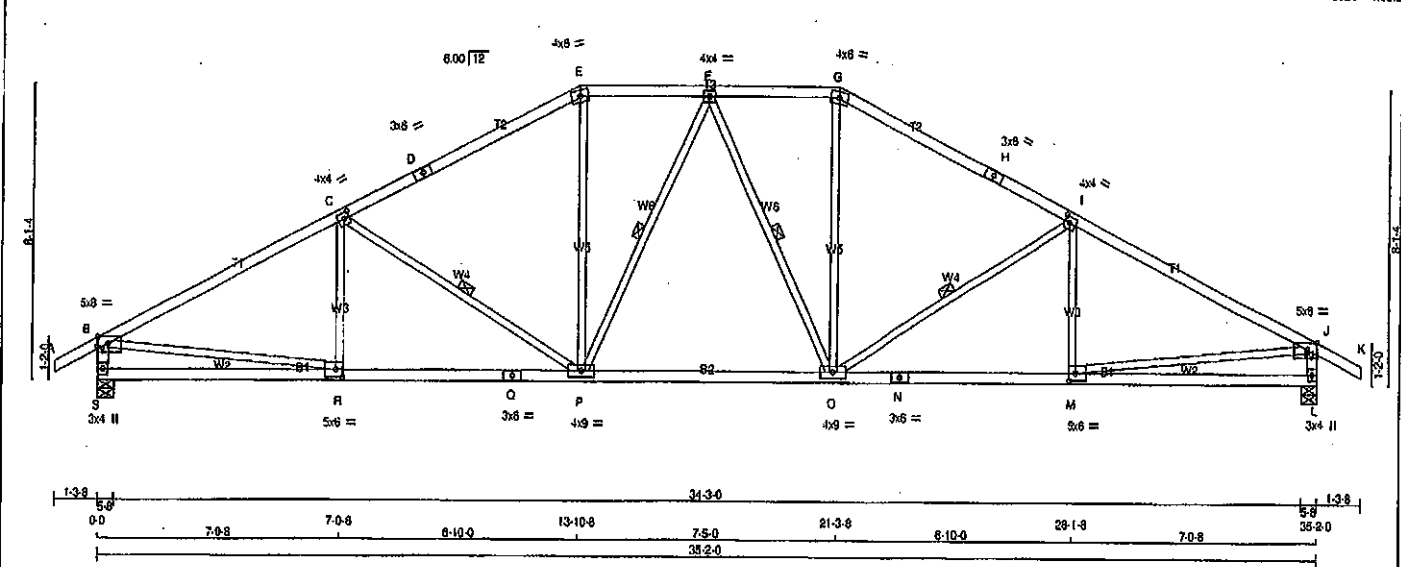

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
<u>BEARINGS</u>							
	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQ'D BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT IN-SX		IN-SX
JT							
S	2063	0	2063	0	0	5-8	5-8
L	2063	0	2063	0	0	5-8	5-8

<u>UNFACTORED REACTIONS</u>							
	1ST LCASE		MAX. MIN. COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 . 0	0 / 0
L	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 . 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

TOTAL WEIGHT = $2 \times 145 = 291$ LB
 (M.F.)
DESIGN CRITERIA
 SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN. CC
 LOADING IN FLAT SECTION BASED ON A SLOPE
 OF 0.00/12
 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
 RUM

PLATES (table in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	8.0	Edge	3.50
C	TMWW-t	MT20	4.0	4.0	2.00	1.75
D	TS-t	MT20	3.0	6.0		
E	TTW-m	MT20	4.0	6.0		
F	TMWW-t	MT20	4.0	4.0		
G	TTW-m	MT20	4.0	6.0		
H	TS-t	MT20	3.0	8.0		
I	TMWV-t	MT20	4.0	4.0	2.00	1.75
J	TMWV-p	MT20	5.0	8.0	Edge	3.50
L	BMVt+p	MT20	3.0	4.0		
M	BMWW-t	MT20	5.0	8.0	2.50	2.25
N	BS-t	MT20	3.0	6.0		
O	BMWWV-t	MT20	4.0	9.0		
P	BMWWV-t	MT20	4.0	9.0		
Q	BS-t	MT20	3.0	6.0		
R	BMWW-t	MT20	5.0	6.0	2.50	2.25
S	BMVt+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-P, F-P, F-O, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)	
FR-TO		FROM TO			FR-TO				
A-B	0/28	-91.8 -91.8	0.12 (1)	10.00	R-C	-182.52	0.08 (1)		
B-C	-2906/0	-91.8 -91.8	0.83 (1)	3.25	C-P	-637.0	0.29 (1)		
C-D	-2373/0	-91.8 -91.8	0.72 (1)	3.66	P-E	0/674	0.15 (1)		
D-E	-2373/0	-91.8 -91.8	0.72 (1)	3.66	F-F	-222.0	0.11 (1)		
E-F	-2100/0	-91.8 -91.8	0.19 (1)	4.53	F-O	-222.0	0.11 (1)		
F-G	-2100/0	-91.8 -91.8	0.19 (1)	4.53	O-G	0/674	0.15 (1)		
G-H	-2373/0	-91.8 -91.8	0.72 (1)	3.66	O-I	-837.0	0.29 (1)		

PART 9 OF CBCB 2018, CBC 2012, ABC 2019
 PART 9 OF CBC 2018 (2019 AMENDMENT)
 CSA 088-09, CSA 088-14
 TPIC 2011, TPIC 2014
 (55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
 LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF
 LIVE LOAD
 ALLOWABLE DEFL.(LL)= L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
 ALLOWABLE DEFL.(TL)= L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.30")
 CS: TC=0.89/1.00 (J=1), BC=0.52/1.00 (M=0),
 WB=0.60/1.00 (J=M=1), SS=0.28/1.00 (B=C=1)
 DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10
 COMPANION LIVE LOAD FACTOR = 1.00



Professional Engineer

I-J	-2008*0	-91.8	-91.8	0.83 (1)	3.25	B-R	0.2849	0.60 (1)
J-K	0:28	-91.8	-91.8	0.12 (1)	10.00	M-J	0.2849	0.60 (1)
S-B	-2008*0	0.0	0.0	0.20 (1)	5.98			
L-J	-2008*0	0.0	0.0	0.20 (1)	5.98			
S-R	0*0	-18.5	-18.5	0.20 (4)	10.00			
R-Q	0:2830	-18.5	-18.5	0.52 (1)	10.00			
Q-P	0:2830	-18.5	-18.5	0.52 (1)	10.00			
P-O	0:2193	-18.5	-18.5	0.45 (1)	10.00			
O-N	0:2830	-18.5	-18.5	0.52 (1)	10.00			
N-M	0:2830	-18.5	-18.5	0.52 (1)	10.00			
M-L	0*0	-18.5	-18.5	0.20 (4)	10.00			

TRUSS MANUFACTURING IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (D)	SHEAR (F)	SECTION (F)
	(PSI)	(PL)	(PL)
	MAX MIN	MAX MIN	MAX MIN
MT20	616 354	1667 788	1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg



JOB NAME 408268	TRUSS NAME T35	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:54:36 2020 Page 1
 ID=DMCubINVR6TsFos31v6I_zns11-VESGlm50dHnDuN4Sx4StDUGAQldYMEbE41lyzMEVXX

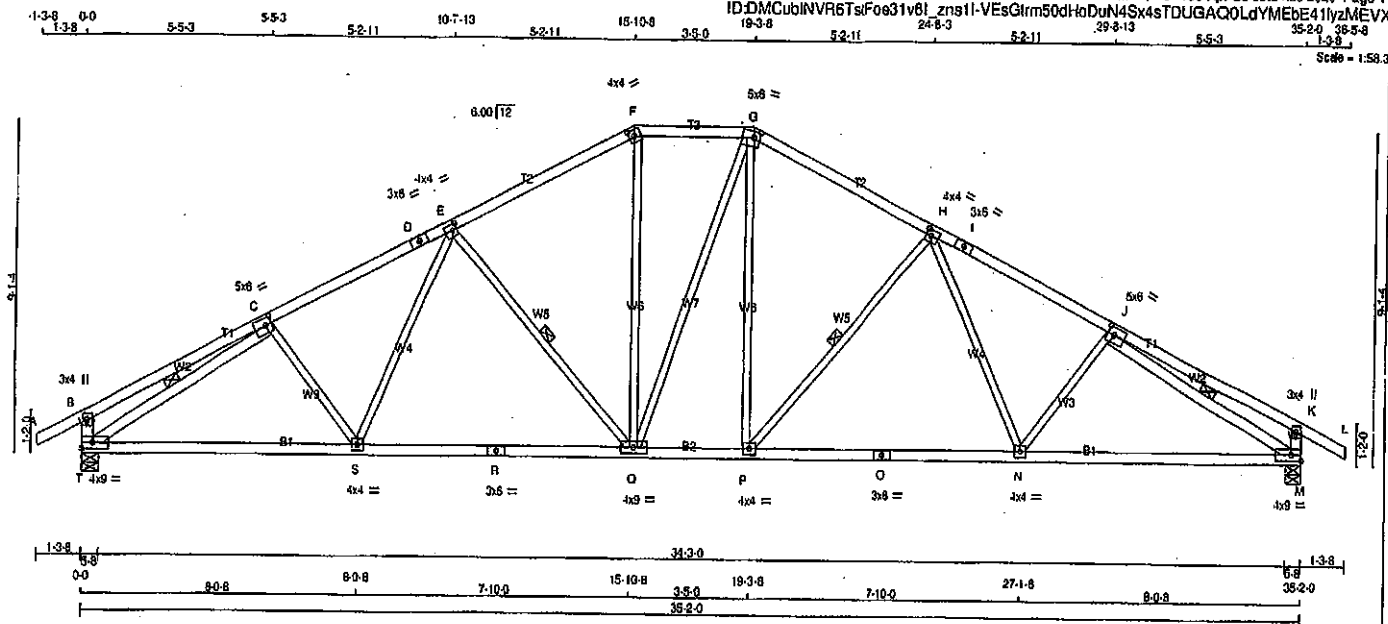

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
I - L	2x4	DRY	No.2	SPF
L - B	2x4	DRY	No.2	SPF
M - K	2x4	DRY	No.2	SPF
T - R	2x4	DRY	No.2	SPF
R - O	2x4	DRY	No.2	SPF
O - M	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT T - C	2x3	DRY	No.2	SPF
J - M	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMWW-I	MT20	5.0	6.0	2.50	2.25
D TS-I	MT20	3.0	6.0		
E TMWW-I	MT20	4.0	4.0	2.00	1.50
F TTW-h	MT20	4.0	4.0	2.00	1.75
G TTWW-m	MT20	5.0	6.0	2.00	2.00
H TMWW-I	MT20	4.0	4.0	2.00	1.50
I TS-I	MT20	3.0	6.0		
J TMWW-I	MT20	5.0	6.0	2.50	2.25
K TMV+p	MT20	3.0	4.0		
M BMVW-I	MT20	4.0	9.0		Edge
N P-S					
N BMWW-I	MT20	4.0	4.0		
O BS-I	MT20	3.0	6.0		
Q BMWW-I	MT20	4.0	9.0		
R SS-I	MT20	3.0	6.0		
T BMVW-I	MT20	4.0	9.0		Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	2063	0	0	5-8
T	2063	0	0	5-8
M	2063	0	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
T	1457	989 / 0	0 / 0
M	1457	989 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, H-P, C-T, J-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)
FR-TO	0:28	-91.8	-91.8 0.12 (1)	FR-TO	0:28	-91.8	-91.8 0.12 (1)
A-B	0:28	-91.8	-91.8 0.12 (1)	C-S	-110:37	0.04	0.04 (1)
B-C	0:20	-91.8	-91.8 0.12 (1)	S-E	0:277	0.08	0.08 (1)
C-D	-2760:0	-91.8	-91.8 0.40 (1)	E-Q	-681:0	0.31	0.31 (1)
D-E	-2760:0	-91.8	-91.8 0.40 (1)	Q-F	0:613	0.14	0.14 (1)
E-F	-2187:0	-91.8	-91.8 0.35 (1)	F-G	0:4	0.00	0.00 (1)
F-G	-1925:0	-91.8	-91.8 0.18 (1)	G-H	0:809	0.14	0.14 (1)
G-H	-2185:0	-91.8	-91.8 0.38 (1)	H-I	-883:0	0.31	0.31 (1)
H-I	-2781:0	-91.8	-91.8 0.40 (1)	I-J	0:279	0.08	0.08 (1)
I-J	-2781:0	-91.8	-91.8 0.40 (1)	J-K	-110:37	0.04	0.04 (1)
J-K	0:20	-91.8	-91.8 0.32 (1)	K-L	-3042:0	0.61	0.61 (1)
K-L	0:28	-91.8	-91.8 0.12 (1)	L-M	-3043:0	0.61	0.61 (1)
T-B	-325:0	0.0	0.0 0.03 (1)				
M-K	-325:0	0.0	0.0 0.03 (1)				
T-S	0:2538	-18.5	-18.5 0.56 (1)				
S-R	0:2362	-18.5	-18.5 0.53 (1)				
R-Q	0:2362	-18.5	-18.5 0.53 (1)				
Q-P	0:1924	-18.5	-18.5 0.40 (1)				
P-O	0:2362	-18.5	-18.5 0.53 (1)				
O-N	0:2362	-18.5	-18.5 0.53 (1)				
N-M	0:2538	-18.5	-18.5 0.56 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/889 (0.14")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.29")

CSI: TC=0.40/1.00 (H-J:1), BC=0.56/1.00 (M-N:1), WB=0.61/1.00 (J-M:1), SS=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354 1807 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (F) (INPUT = 0.90)
 JSI METAL = 0.83 (C) (INPUT = 1.00)



Structural component only
 DWG# T-2007719

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408268	T36	5	1	TRUSS DESC.		

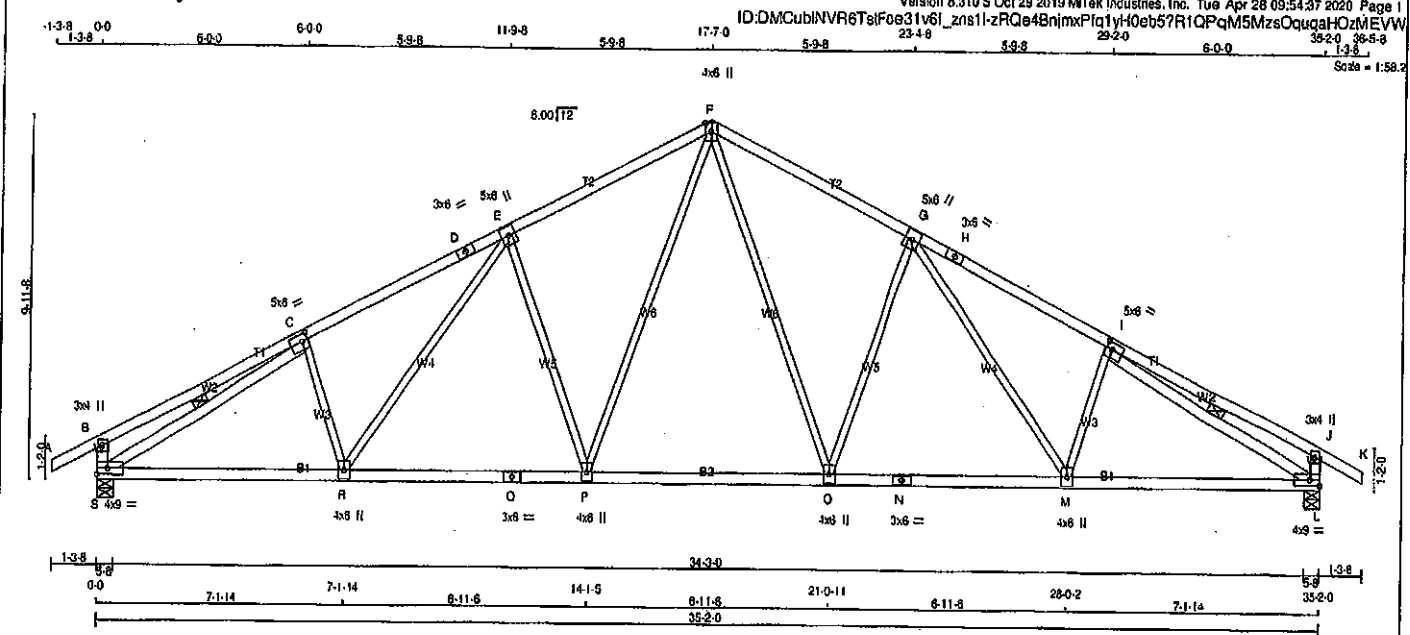

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVp	MT20	3.0	4.0	
C	TMWW-I	MT20	5.0	6.0	2.25 2.00
D	TS-I	MT20	3.0	6.0	
E	TMWW-I	MT20	5.0	6.0	
F	TTWWap	MT20	4.0	6.0	Edge
G	TMWW-I	MT20	5.0	6.0	
H	TS-I	MT20	3.0	6.0	
I	TMWW-I	MT20	5.0	6.0	2.25 2.00
J	TMVp	MT20	3.0	4.0	
L	BMVW-I	MT20	4.0	9.0	Edge
M, O, P, R					
N	BMWW-I	MT20	4.0	6.0	
Q	BS-I	MT20	3.0	6.0	
Q	BS-I	MT20	3.0	6.0	
S	BMVW-I	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
S	2063	0	2063	0	5-8
L	2063	0	2063	0	5-8

UNFACTORED REACTIONS					
1ST CASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD
JT	1457	969 / 0	0 / 0	0 / 0	188 / 3
S	1457	969 / 0	0 / 0	0 / 0	188 / 3
L	1457	969 / 0	0 / 0	0 / 0	188 / 3

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, I-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS						WEBS					
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAG LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)				
FR-TO		FROM TO			FR-TO						
A-B	0.28	-91.8	-91.8	0.12 (1)	10.00	F-O	0.886 0.19 (1)				
B-C	0.22	-91.8	-91.8	0.40 (1)	10.00	O-G	-728.0 0.72 (1)				
C-D	-2808.0	-91.8	-91.8	0.49 (1)	3.75	G-M	0.391 0.09 (1)				
D-E	-2808.0	-91.8	-91.8	0.49 (1)	3.75	M-I	-192.18 0.05 (1)				
E-F	-2322.0	-91.8	-91.8	0.48 (1)	4.07	P-F	0.886 0.19 (1)				
F-G	-2322.0	-91.8	-91.8	0.48 (1)	4.07	E-P	-728.0 0.72 (1)				
G-H	-2808.0	-91.8	-91.8	0.49 (1)	3.75	R-E	0.391 0.09 (1)				
H-I	-2808.0	-91.8	-91.8	0.49 (1)	3.75	C-R	-192.18 0.05 (1)				
I-J	0.22	-91.8	-91.8	0.40 (1)	10.00	S-C	-3084.0 0.72 (1)				
J-K	0.28	-91.8	-91.8	0.12 (1)	10.00	I-L	-3084.0 0.72 (1)				
S-B	-344.0	0.0	0.0	0.03 (1)	7.81						
L-J	-344.0	0.0	0.0	0.03 (1)	7.81						
S-R	0.2574	-18.5	-18.5	0.53 (1)	10.00						
R-Q	0.2291	-18.5	-18.5	0.47 (1)	10.00						
Q-P	0.2291	-18.5	-18.5	0.47 (1)	10.00						
P-O	0.1782	-18.5	-18.5	0.38 (1)	10.00						
O-N	0.2291	-18.5	-18.5	0.47 (1)	10.00						
N-M	0.2291	-18.5	-18.5	0.47 (1)	10.00						
M-L	0.2574	-18.5	-18.5	0.53 (1)	10.00						

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSI: TC=0.49/1.00 (C-E:1), BC=0.53/1.00 (L-M:1), WB=0.72/1.00 (E-P:1), SS=0.22/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1697 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (C) (INPUT = 0.90)
JSI METAL = 0.77 (I) (INPUT = 1.00)



Structural component only
DWG# T-2007720

LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options Information on p. 126.




Double-Shear
Nailing
Top View




Double-Shear
Nailing
Side View;
Do not
bend tab




Dome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,580

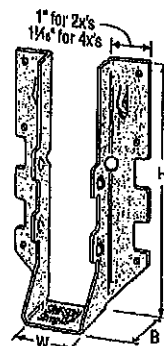


✓ LUS28




LU26L

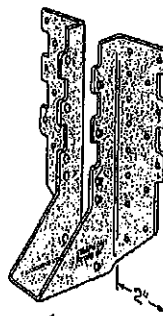

✓ HUS210
(HUS26, HUS28,
and HHUS similar)


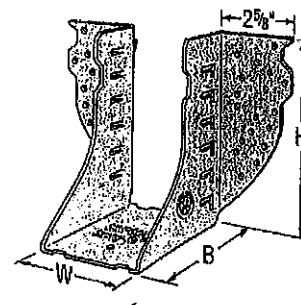


✓ HGUS28-2



✓ HHUS210-2

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

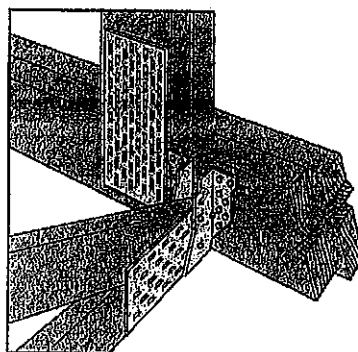

LJS26DS

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options Information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.82 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
$W < 2"$	Bevel or square cut	0.62 of table value	0.46 of table value
$2" < W < 6"$	Bevel cut	0.67 of table value	0.41 of table value
$2" < W < 6"$	Square cut	0.46 of table value	0.41 of table value
$W > 6"$	Bevel cut	0.75 of table value	0.41 of table value

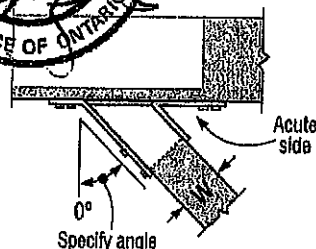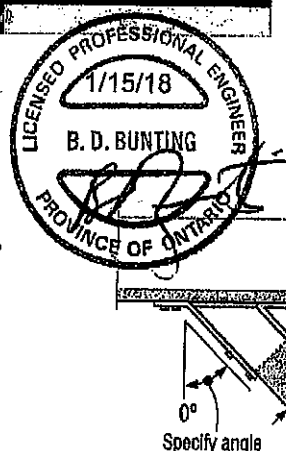

**Top View HHUS Hanger
Skewed Right**
(Joist must be bevel cut)
All joist nails installed on the
outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ^a	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN	(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN
Single 2x Sizes											
LUS24	18	1 1/8	3 1/4	1 1/4	2 1/4	(4) 10d	(2) 10d	710 316	1625 723	845 287	1155 514
LU24L	22	1 1/8	3	1 1/4	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360 160	1020 454	320 142	725 3.22
LU26L	22	1 1/8	5	1 1/4	4 1/4	(6) 10d	(4) 10d x 1 1/2"	720 320	1605 714	645 287	1140 5.07
LUS26	18	1 1/8	4 1/4	1 1/4	3 3/4	(4) 10d	(4) 10d	1420 632	2170 965	1290 5.74	1630 7.25
HUS26	16	1 1/8	5 1/4	3	3 1/8	(14) 10d	(8) 16d	2705 1130	4940 2197	2065 9.20	3875 17.24
LJS26DS	18	1 1/8	5	3 1/2	4 1/4	(16) 16d	(6) 16d	2055 814	4265 1897	1460 6.49	4115 18.31
HGUS26	12	1 1/8	5 1/4	5	4 1/4	(20) 16d	(8) 16d	2685 1196	6625 2951	2685 1196	5700 25.35
LU28L	20	1 1/8	6 1/4	1 1/4	5 1/4	(8) 10d	(6) 10d x 1 1/2"	1140 507	2185 9.72	1020 4.54	1550 6.89
LUS28	18	1 1/8	6 1/4	1 1/4	3 3/4	(6) 10d	(4) 10d	1420 632	2520 1121	1290 5.74	1790 7.96
HUS28	16	1 1/8	7 1/4	3	6 1/8	(22) 16d	(8) 16d	3605 1604	5385 2386	2675 1180	4345 19.33
HGUS28	12	1 1/8	7 1/4	5	6 1/4	(38) 16d	(12) 16d	3310 1474	7675 3419	3310 14.74	6900 30.73
LU210L	20	1 1/8	8	1 1/4	7 1/4	(10) 10d	(6) 10d x 1 1/2"	1140 507	2495 1110	1020 4.54	1770 7.87
LUS210	18	1 1/8	7 1/4	1 1/4	3 3/4	(8) 10d	(4) 10d	1420 632	2785 1239	1290 5.74	2210 9.83

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

SIMPSON
Strong-Tie

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (In.)				Fasteners		Factored Resistance							
		W	H	B	d _o ³	Header	Joist	D.Fir-L		S-P-F					
								Uplift	Normal	Uplift	Normal				
								(K _D = 1.15) lb.	(K _D = 1.00) lb.	(K _D = 1.15) lb.	(K _D = 1.00) lb.				
kN												kN	kN	kN	kN
Double 2x Sizes															
LUS24-2	18	3 3/8	3 3/8	2	1 1/2	(4) 18d	(2) 18d	835	2020	590	1435				
LUS26-2	18	3 3/8	4 7/8	2	4	(4) 18d	(4) 18d	3.71	8.99	2.62	6.38				
								1720	2595	1545	1920				
HHUS26-2	14	3 3/8	5 3/8	3	3 1/4	(14) 16d	(6) 16d	7.65	11.54	6.87	8.54				
								2850	7335	2085	5205				
HGUS26-2	12	3 3/8	5 3/8	4	4 1/4	(20) 16d	(8) 16d	12.68	32.63	9.20	23.15				
								4385	8950	3110	6355				
LUS28-2	18	3 3/8	7	2	4	(8) 18d	(4) 18d	19.51	39.81	13.83	28.27				
								1720	3325	1545	2575				
HHUS28-2	14	3 3/8	7 3/8	3	6 1/4	(22) 16d	(8) 16d	7.65	14.79	6.87	11.45				
								3765	8940	2675	6345				
HGUS28-2	12	3 3/8	7 3/8	4	8 1/4	(36) 16d	(12) 16d	16.75	39.77	11.90	28.22				
								6070	12980	4310	9215				
LUS210-2	18	3 3/8	9	2	6	(8) 18d	(8) 18d	27.00	57.74	19.17	40.99				
								2580	4500	2320	3195				
HHUS210-2	14	3 3/8	9 3/8	3	8	(30) 16d	(10) 16d	11.48	20.02	10.32	14.21				
								4670	9660	4235	7000				
HGUS210-2	12	3 3/8	9 3/8	4	8 3/4	(46) 18d	(16) 16d	20.77	42.97	18.84	31.14				
								6840	14015	4855	10270				
								30.43	62.34	21.60	45.69				
Triple 2x Sizes															
HGUS26-3	12	4 1/8	5 1/2	4	4 1/4	(20) 16d	(8) 16d	4385	8950	3110	6355				
HGUS28-3	12	4 1/8	7 1/4	4	6 3/8	(36) 16d	(12) 16d	19.51	39.81	13.83	28.27				
								6070	12980	4310	9215				
HHUS210-3	14	4 1/8	9	3	7 3/8	(30) 16d	(10) 16d	27.00	57.74	19.17	40.99				
								4670	9670	4235	6865				
HGUS210-3	12	4 1/8	9 1/4	4	8 3/4	(46) 16d	(16) 16d	20.77	43.02	18.84	30.54				
								6840	14645	4855	10400				
								30.43	65.14	21.60	46.26				
Quadruple 2x Sizes															
HGUS26-4	12	6 3/8	5 3/8	4	4 3/4	(20) 16d	(8) 16d	4385	8950	3110	6355				
HGUS28-4	12	6 3/8	7 3/8	4	6 3/8	(36) 16d	(12) 16d	19.51	39.81	13.83	28.27				
								6070	12980	4310	9215				
HHUS210-4	14	6 3/8	8 3/8	3	7 3/8	(30) 16d	(10) 16d	27.00	57.74	19.17	40.99				
								4670	10155	4235	7210				
HGUS210-4	12	6 3/8	8 3/8	4	8 3/4	(46) 16d	(16) 16d	20.77	45.17	18.84	32.07				
								6840	14645	4855	10400				
HGUS212-4	12	6 3/8	10 3/8	4	10 3/8	(56) 16d	(20) 16d	30.43	65.14	21.60	46.26				
								7640	14995	5425	10645				
HGUS214-4	12	6 3/8	12 3/8	4	11 3/8	(66) 16d	(22) 16d	33.98	66.70	24.13	47.35				
								10130	16400	7195	11645				
								45.06	72.95	32.00	51.80				
4x Sizes															
LUS46	18	3 3/8	4 3/8	2	3 3/8	(4) 18d	(4) 18d	1720	2595	1545	1920				
HHUS46	14	3 3/8	5 3/8	3	3 1/4	(14) 18d	(6) 18d	7.65	11.54	6.87	8.54				
								2540	7335	2085	5205				
HGUS46	12	3 3/8	5 3/8	4	4 1/4	(20) 16d	(8) 16d	11.30	32.63	9.20	23.15				
								4385	8950	3110	6355				
LUS48	18	3 3/8	6 3/8	2	3 3/4	(8) 18d	(4) 16d	19.51	39.81	13.83	28.27				
								1720	3325	1545	2575				
HHUS48	14	3 3/8	7 1/4	3	6 1/4	(22) 16d	(8) 18d	7.65	14.79	6.87	11.45				
								3765	8940	2675	6345				
HGUS48	12	3 3/8	7 1/8	4	6 3/8	(36) 16d	(12) 16d	16.75	39.77	11.90	28.22				
								6070	12980	4310	9215				
LUS410	18	3 3/8	8 3/4	2	5 3/8	(8) 18d	(8) 18d	27.00	57.74	19.17	40.99				
								2580	4500	2320	3195				
HGUS410	12	3 3/8	9	4	8 3/4	(46) 18d	(16) 16d	11.48	20.02	10.32	14.21				
								4670	9660	4235	7000				
HGUS412	12	3 3/8	10 3/8	4	10 3/8	(56) 16d	(20) 16d	20.77	42.97	18.84	31.14				
								6840	14015	4855	10270				
HGUS414	12	3 3/8	12 3/8	4	11 3/8	(66) 16d	(22) 16d	30.43	62.34	21.60	45.69				
								7640	14995	5425	10645				
								33.98	66.70	24.13	47.35				
								10130	16400	7195	11645				
								45.06	72.95	32.00	51.80				

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1¼". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1½" = 0.148" dia. x 1½" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titan® screws into the top and face of masonry wall. See optional load tables and installation details.

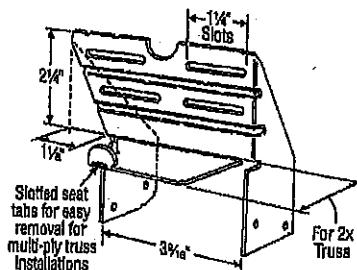


TC24
U.S. Patent 4,832,173

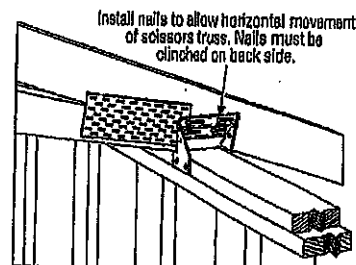


Typical TC24 Installation

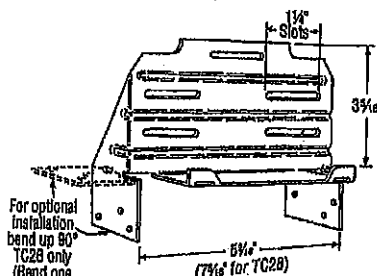

TC26
(TC28 Similar)

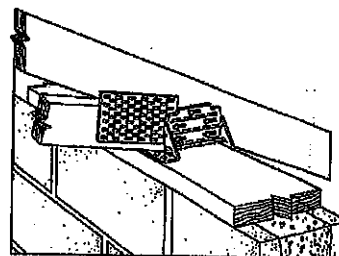

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer
(8", 10", 12" Wall Installation Similar)

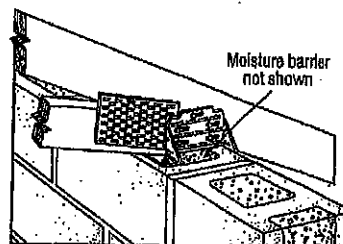


Optional TC26 Installation for Grouted Concrete Block using Titan Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K ₀ =1.15) lb.	Uplift (K ₀ =1.15) lb.
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K ₀ =1.15) lb.	Uplift (K ₀ =1.15) lb.
TC26	(5) 10d	(6) 10d x 1½"	810	680
	(5) 10d	(6) 10d	930	680

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC28 installation with 10d nails requires minimum 3" top plate thickness.
4. TC28 fastened to grouted concrete block with (5) - ¾" x 2½" Titan screws has a factored uplift resistance of 275 lb.

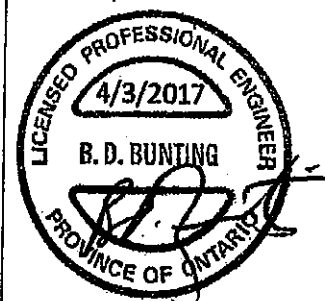

(800) 999-5099
strongtie.com

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_D = 1.15$)					
					D.Fir-L			S-P-F		
		To Rafters/Trusses	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(8) 8d x 1½"	(4) 8d	—	740	885	300	680	485	215
					3.29	3.05	1.33	3.02	2.18	0.96
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	765	160	160
					3.58	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	180	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	265	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	18	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	18	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ¹	18	(5) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A ¹	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	565	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^{2,3}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1465	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	① (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
		② (12) 8d x 1½"	(15) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
TSP	18	(9) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
					5.76	1.96	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.96	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.6A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (6) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.162" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

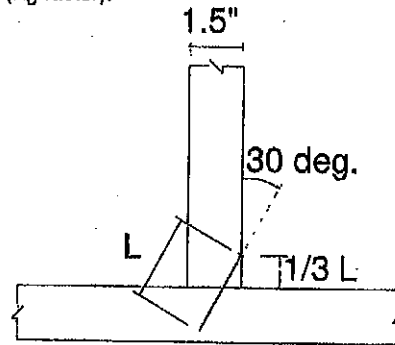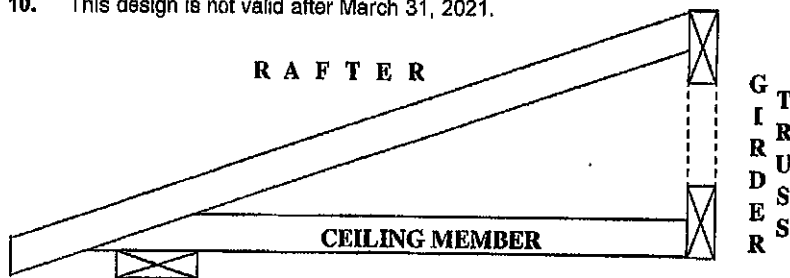


TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

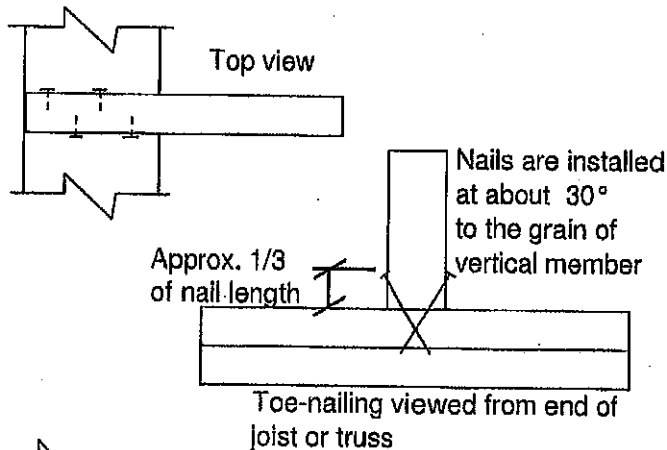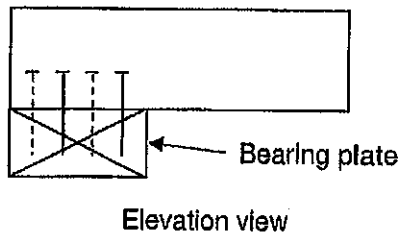

Toe-nailing on 2x4 Bearing Plate

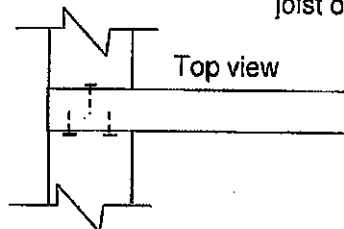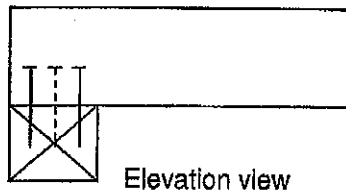

MiTek®

MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7


PEO
Certificate No. 10889486




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/8" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.

Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

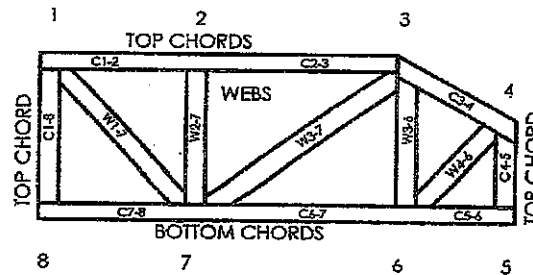

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L 10319-L 13270-L 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MII-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See 8CSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.


TN 15-001 Piggyback Bracing

Overview:

Where piggybacks are connected ovetop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

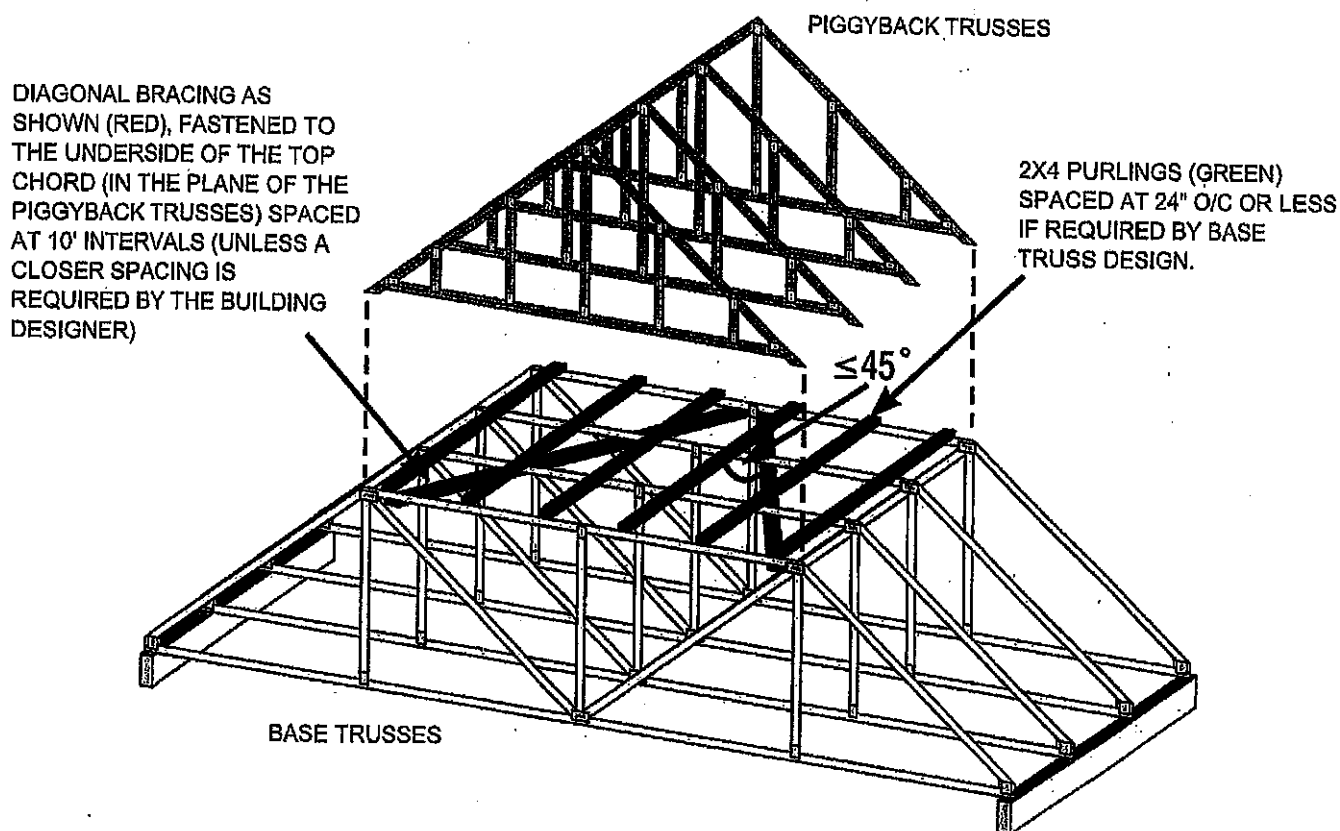


NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.

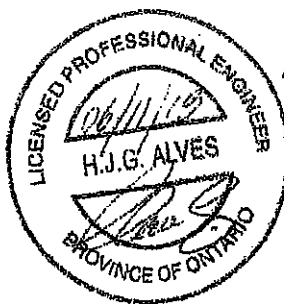

Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1300213

Feb 09, 2018