

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

FEB 04 2021

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012
(2019 amendment) OCCUPANCY:
RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

CITY OF HAMILTON
Building Division

HARDWARE:
HGUS26-2 - (XX)
LJS26DS - (V)
LUS24 - (O)
LUS26-2-(VV)

Permit No. 21-105990


THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

BEAMS:
B30= B31 =
2 - 2x10 SPF #2

FOR CHIEF BUILDING OFFICIAL
DATE FEB 26 2021

 DENOTES:
CONVENTIONAL
FRAMING

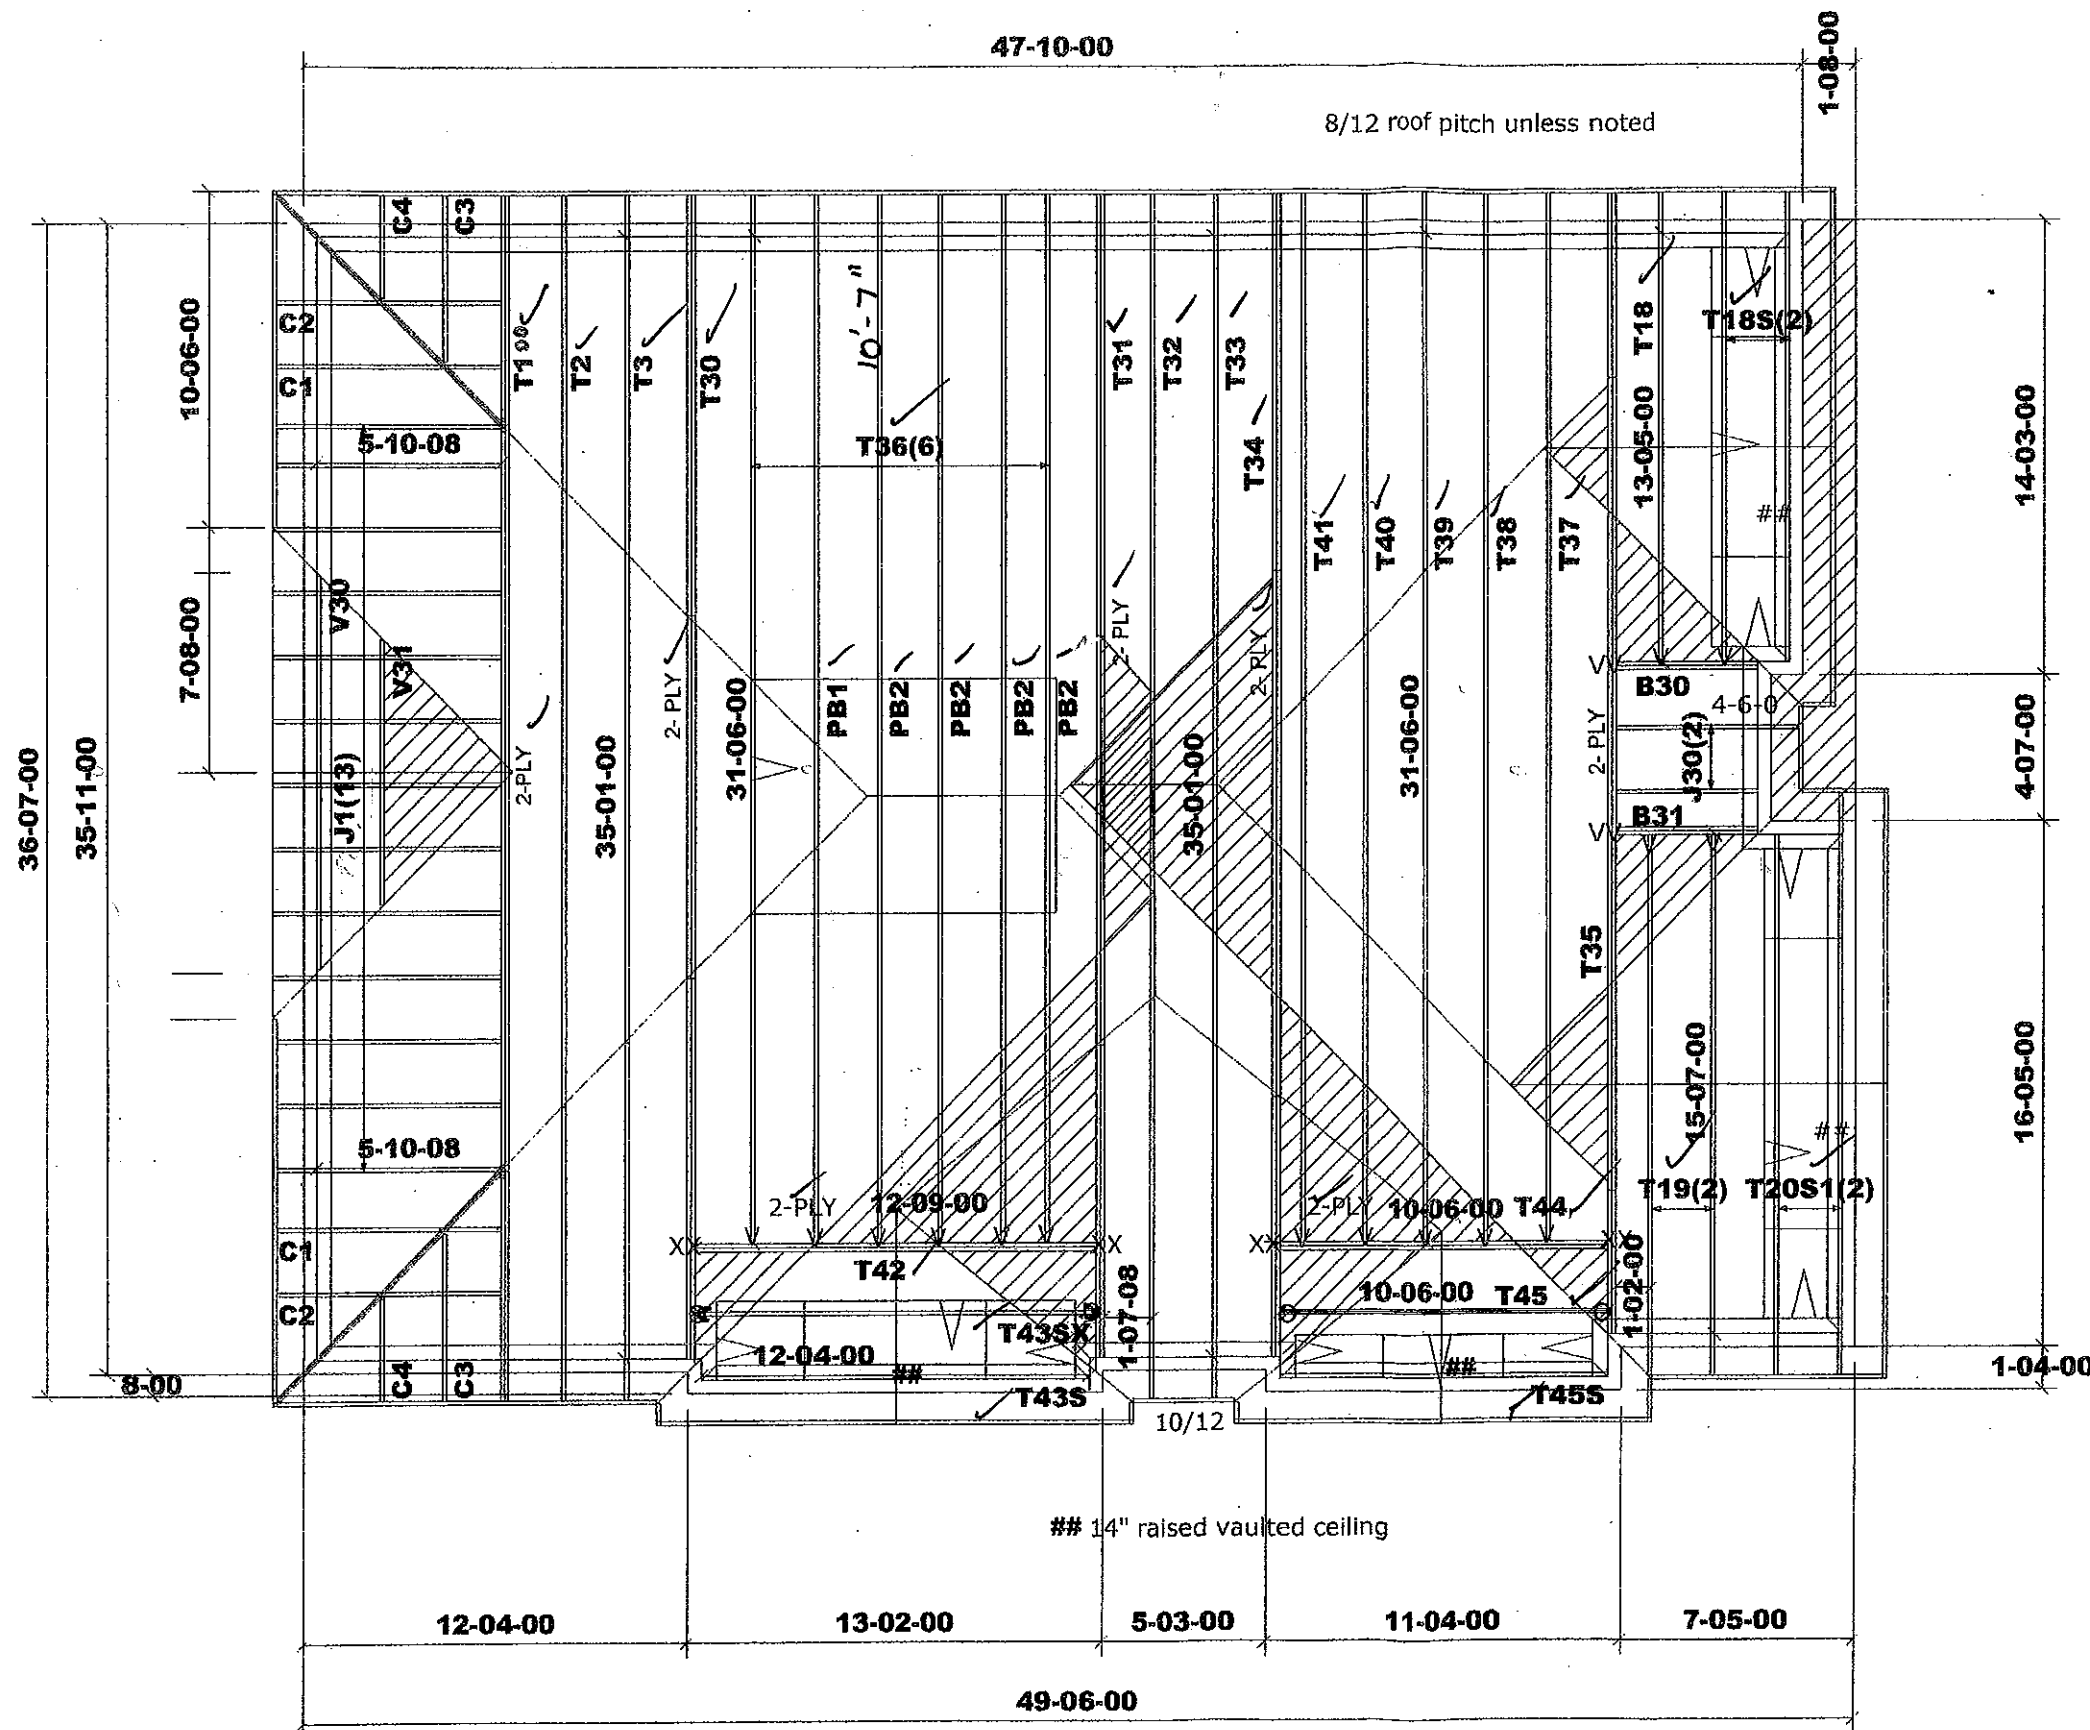

ML3140



Job Track: 51225
Plan Log: 202439
Layout ID: 408316

Builder / Location:
GREEN PARK HOMES / WATERDOWN
Project: RUSSELL GARDENS PH.3
Date: 2020-04-29 Sales: Mario DiCano Designer: JG

Model / Elevation:
MOUNTAINASH 12/2

LOT 256

File: ver 8.3.1.215

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 12
 Lot #: 256
 Elevation: 2

Job Track: 51225
 PlanLog: 202439
 Layout ID: 408316
 Ref #
 Page: 1 of 3
 Date: 04-29-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T100 Hip Girder	8 / 12	35-01-00	5-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	327.59 201.00		
	1	T2 Hip	8 / 12	35-01-00	6-07-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	150.61 96.17		
	1	T3 Hip	8 / 12	35-01-00	7-11-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	157.43 98.33		
	1	T18 Common	8 / 12	13-05-00	5-10-08	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	58.32 37.00		
	2	T18S Roof Special	8 / 12 5 / 12	13-05-00	5-10-08	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	114.8 74.00		
	2	T19 Common	8 / 12	15-07-00	6-07-02	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	132.91 84.00		
	2	T20S1 Roof Special	8 / 12 5 / 12	15-07-00	6-07-02	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	131.62 86.33		
	1 2-ply	T30 Hip Girder	8 / 12	35-01-00	9-03-15	2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	437.22 265.00		
	1 2-ply	T31 Roof Special Girder	8 / 12	35-01-00	9-09-02	2 x 4 2 x 6	1-03-08	1-04-13 1-07-10	377.44 230.67		
	1	T32 Roof Special	8 / 12	35-01-00	10-11-02	2 x 4	1-03-08 1-03-08	1-04-13 1-07-10	187.9 115.87		
	1	T33 Roof Special	8 / 12	35-01-00	9-08-13	2 x 4	1-03-08 1-03-08	1-04-13 1-07-10	169.66 106.50		
	1 2-ply	T34 Roof Special Girder	8 / 12	35-01-00	8-04-13	2 x 4 2 x 6	1-03-08	1-04-13 1-07-10	369.66 228.33		
	1 2-ply	T35 Hip Girder	8 / 12	34-05-00	4-04-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	348.56 217.33		
	6	T36 Hip	8 / 12	31-06-00	10-07-13	2 x 4	1-03-08	1-04-13 3-09-08	984.11 610.00		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 12
 Lot #: 256
 Elevation: 2

Job Track: 51225
 PlanLog: 202439
 Layout ID: 408316
 Ref #
 Page: 2 of 3
 Date: 04-29-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T37 Hip	8 /12	31-06-00	5-08-13	2 x 4	1-03-08	1-04-13 3-04-02	129.05 81.67		
	1	T38 Hip	8 /12	31-06-00	7-00-13	2 x 4	1-03-08	1-04-13 3-04-02	139.38 87.17		
	1	T39 Hip	8 /12	31-06-00	8-04-13	2 x 4	1-03-08	1-04-13 3-04-02	148.29 92.67		
	1	T40 Hip	8 /12	31-06-00	9-08-13	2 x 4	1-03-08	1-04-13 3-04-02	168.47 99.67		
	1	T41 Hip	8 /12	31-06-00	11-00-13	2 x 4	1-03-08	1-04-13 3-04-02	155.42 96.50		
	1 2-ply	T42 Common Girder	8 /12	12-09-00	5-06-02	2 x 4 2 x 6		1-03-02 1-03-02	128.29 78.67		
	1	T43S Roof Special	8 /12 5 /12	12-04-00	5-06-02	2 x 4		1-04-13 1-04-13	50.13 32.67		
	1	T43SX Roof Special	8 /12 5 /12	12-09-00	5-06-02	2 x 4		1-03-02 1-03-02	51.43 33.67		
	1 2-ply	T44 Common Girder	8 /12	10-06-00	4-10-13	2 x 4		1-04-13 1-04-13	93.02 60.00		
	1	T45 Common	8 /12	10-06-00	4-10-13	2 x 4		1-04-13 1-04-13	40.51 25.50		
	1	T45S Roof Special	8 /12 5 /12	10-06-00	4-10-13	2 x 4		1-04-13 1-04-13	43.88 29.00		
	1	PB1 Piggyback	8 /12	7-04-00	1-04-00	2 x 4			19.39 13.17		
	4	PB2 Piggyback	8 /12	7-04-00	2-05-05	2 x 4			72.32 46.67		
	1	V30 Valley	8 /12	12-03-00	4-01-00	2 x 4			35.76 23.00		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 12
 Lot #: 256
 Elevation: 2

Job Track: 51225
 PlanLog: 202439
 Layout ID: 408316
 Ref #
 Page: 3 of 3
 Date: 04-29-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	V31 Valley	8 / 12	8-03-00	2-09-00	2 x 4			21.09 14.17		
	13	J1 Jack-Open	8 / 12	5-10-08	5-03-13	2 x 4	1-05-00	1-04-13 5-03-13	251.71 151.87		
	2	J30 Jack-Open	8 / 12	4-06-00	4-04-13	2 x 4	1-03-08	1-04-13 4-04-13	31.48 20.67		
	2	C1 Jack-Open	8 / 12	3-10-15	4-00-02	2 x 4	1-03-08 1-11-09	1-04-13 4-00-02	33 20.67		
	2	C2 Jack-Open	8 / 12	1-10-15	2-08-02	2 x 4	1-03-08 3-11-09	1-04-13 2-08-02	27.45 18.00		
	2	C3 Jack-Open	8 / 12	2-00-00	4-00-02	2 x 4	1-03-08 1-10-15	1-04-13 2-08-13	24.63 15.33		
	2	C4 Jack-Open	8 / 12	1-10-15	2-08-02	2 x 4	1-03-08 1-01	1-04-13 2-08-02	19.15 12.67		

TOTAL # TRUSS= 70

TOTAL BFT OF ALL TRUSSES= 3503.54

BFT.

TOTAL WEIGHT OF ALL TRSSES 5621.57 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
4	Hardware	HGUS28-2	
15	Hardware	LJS28DS	
4	Hardware	LUS24	
2	Hardware	LUS28-2	

TOTAL NUMBER OF
ITEMS=

25


JOB NAME 408315	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTech Industries, Inc. Thu Apr 30 09:31:31 2020 Page 1

ID:DMCubINVR6TstFos31v8l_zns11-gwC7aEIXum?YIAgletJIBresjhyC01QXp2d_zLa/a

1-3-8 0-0 5-10-8 5-10-8 5-10-10 11-9-2 13-11-8 3-7-0 17-6-8 3-7-0 21-1-8 23-3-14 5-10-10 29-2-8 5-10-8 35-1-0 38-4-8
Scale = 1:57.8

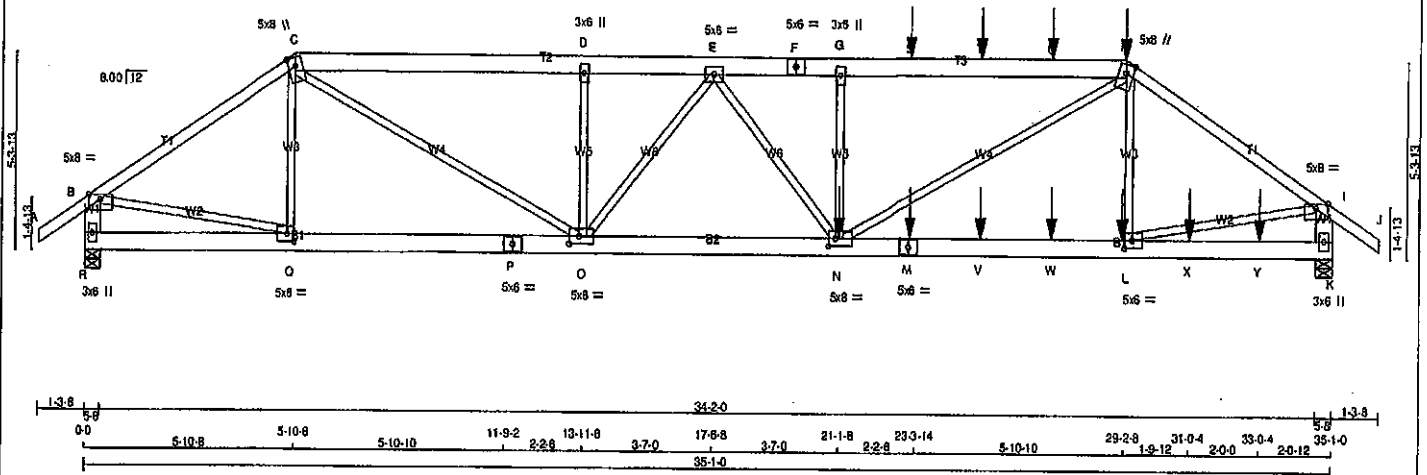

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - F	2x6	DRY	No.2
F - H	2x6	DRY	No.2
H - J	2x4	DRY	No.2
J - K	2x6	DRY	No.2
K - L	2x6	DRY	No.2
L - P	2x6	DRY	No.2
P - M	2x6	DRY	No.2
M - K	2x6	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C 1	12	TOP
H-J 1	12	SIDE(61.0)
C-F 2	12	TOP
F-H 2	12	SIDE(61.0)
R-B 2	12	TOP
K-I 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
R-P 2	12	TOP
P-M 2	12	SIDE(183.1)
M-K 2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
L-H 1	6	SIDE(18.3)
N-G 1	6	SIDE(240.7)
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
R	2990	0	2990	0	5-8
K	4041	0	4041	0	5-8

UNFACTORED REACTIONS					
JT	1ST CASE	MAX	MIN	COMPONENT REACTIONS	
R	2109	1413	0	0	0
K	2853	1899	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.84 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING					
TOTAL LOAD CASES: (4)					
CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	MAX	MAX.
MEMB.	FORCE	(PLF)	LC1	CS1 (LC)	UNBRAC
FR-TO					LENGTH
A-B	0/35	-91.8	-91.8	0.07 (1)	10.00
B-C	-3878/0	-91.8	-91.8	0.45 (1)	4.50
C-D	-6111/0	-91.8	-91.8	0.30 (1)	4.58
D-E	-8111/0	-91.8	-91.8	0.23 (1)	4.60
E-F	-7582/0	-91.8	-91.8	0.41 (1)	3.98
F-G	-7582/0	-91.8	-91.8	0.56 (1)	3.98
G-H	-7583/0	-91.8	-91.8	0.56 (1)	3.88
H-I	-7583/0	-91.8	-91.8	0.56 (1)	3.88
I-J	-5157/0	-91.8	-91.8	0.56 (1)	3.88
J-K	-2954/0	-91.8	-91.8	0.07 (1)	10.00
K-L	-3885/0	-91.8	-91.8	0.07 (1)	10.00
L-H	0/0	-18.5	-18.5	0.08 (4)	10.00
M-K	0/0	-18.5	-18.5	0.24 (1)	10.00
N-G	0/0	-18.5	-18.5	0.24 (1)	10.00
O-N	0/0	-18.5	-18.5	0.48 (1)	10.00
P-M	0/0	-18.5	-18.5	0.36 (1)	10.00
Q-P	0/0	-18.5	-18.5	0.36 (1)	10.00
R-Q	0/0	-18.5	-18.5	0.36 (1)	10.00
S-R	0/0	-18.5	-18.5	0.36 (1)	10.00
T-S	0/0	-18.5	-18.5	0.36 (1)	10.00
U-T	0/0	-18.5	-18.5	0.36 (1)	10.00
V-U	0/0	-18.5	-18.5	0.36 (1)	10.00
W-V	0/0	-18.5	-18.5	0.36 (1)	10.00
X-W	0/0	-18.5	-18.5	0.36 (1)	10.00
Y-X	0/0	-18.5	-18.5	0.36 (1)	10.00
Z-Y	0/0	-18.5	-18.5	0.36 (1)	10.00

FACTORED CONCENTRATED LOADS (LBS)					
JT	LOC.	LC1	MAX	FACE	DIR.
H	29-2-8	-538	-538	FRONT	VERT
I	29-1-12	-38	-38	FRONT	VERT
M	23-1-12	-38	-38	FRONT	VERT
N	21-1-8	-1624	-1624	FRONT	VERT
S	23-1-12	-178	-178	FRONT	VERT
T	25-1-12	-178	-178	FRONT	VERT
U	27-1-12	-178	-178	FRONT	VERT
V	25-1-12	-38	-38	FRONT	VERT
W	27-1-12	-38	-38	FRONT	VERT
X	31-0-4	-38	-38	FRONT	VERT
Y	33-0-4	-38	-38	FRONT	VERT

TOTAL WEIGHT = 2 X 175 = 350 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17)
CALCULATED VERT. DEFL. (LL) = L/999 (0.17)
ALLOWABLE DEFL. (TL) = L/360 (1.17)
CALCULATED VERT. DEFL. (TL) = L/999 (0.30)

CSI: TO=0.58/1.00 (H-H), SC=0.48/1.00 (N-C), WB=0.54/1.00 (L-L), SS=0.25/1.00 (G-H)

DOI LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1087 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (L) (INPUT = 0.90)
JSI METAL = 0.54 (L) (INPUT = 1.00)



Structural component only
DWG# T-2008005 1/2

CONTINUED ON PAGE 2

JOB NAME 408315	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:32 2020 Page 2
 ID:DMCubINVR6TstFoe31v6I zns1I-VsUaKwFKIBus9rllCMOYrO00NF3wh/GAeBZc8QzLaf9


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW-p	MT20	5.0	8.0	Edge	
C	ITWW+m	MT20	5.0	8.0	Edge	
D	TMW+w	MT20	3.0	6.0		
E	TMWW-t	MT20	5.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMW+w	MT20	3.0	6.0		
H	ITWW+m	MT20	5.0	8.0	Edge	
I	TMW-p	MT20	5.0	8.0	Edge	
K	BMV-t-p	MT20	3.0	6.0		
L	BMWW-t	MT20	5.0	6.0	2.50	2.50
M	BS-t	MT20	5.0	6.0		
N	BMWW-t	MT20	6.0	8.0	2.50	2.25
O	BMWW-t	MT20	5.0	8.0	2.50	3.25
P	BS-t	MT20	5.0	6.0		
Q	BMWW-t	MT20	5.0	6.0	2.50	2.50
R	BMV-t-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

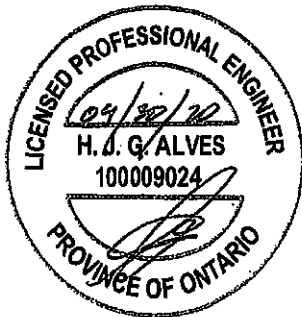


Structural component only,
 DWG# T-2008005 2/2


JOB NAME 408316	TRUSS NAME T100	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Yamarrack Roof Truss, Burlington					

Version 6.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:05:38 2020 Page 1

ID:DMCubINVR6TslFoe31v6L_zns11-bU83W0TggZdH95325Lmslax0Me479K7VAIzqzLa9B



Scale = 1:57.5

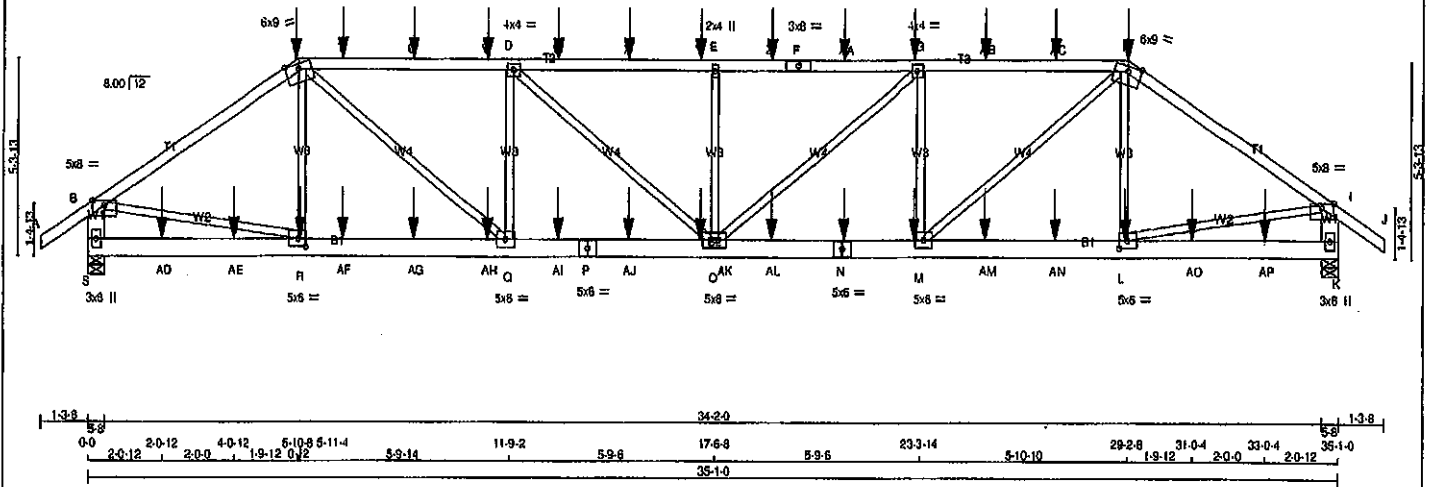

TOTAL WEIGHT = 2 X 164 = 328 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
S - B	2x6	DRY	No.2	SPF	
K - I	2x6	DRY	No.2	SPF	
P - N	2x6	DRY	No.2	SPF	
N - K	2x6	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122'X3') SPIRAL NAILS		
A - C	12	SIDE (61.0)
C - F	12	SIDE (61.0)
F - H	12	SIDE (61.0)
H - J	12	SIDE (61.0)
S - B	12	TOP
K - I	12	TOP
BOTTOM CHORDS : (0.122'X3') SPIRAL NAILS		
S - P	12	SIDE (183.1)
P - N	12	SIDE (183.1)
N - K	12	SIDE (183.1)
WEBS : (0.122'X3') SPIRAL NAILS		
R - C	6	SIDE (19.3)
L - H	6	SIDE (19.3)
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
S	3809	0	3809	0
K	3859	0	3859	0

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
S	2783	1823 / 0	0 / 0	0 / 0	940 / 0
K	2727	1799 / 0	0 / 0	0 / 0	928 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.84 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO		
A-B	0 / 35	-91.8	-91.8 0.07 (1)	10.00	R-C	-431 / 54
B-C	-4949 / 0	-91.8	-91.8 0.35 (1)	3.92	Q-Q	0 / 3051
C-T	-6443 / 0	-91.8	-91.8 0.84 (1)	3.05	Q-D	-1748 / 0
T-U	-6443 / 0	-91.8	-91.8 0.84 (1)	3.05	D-Q	0 / 857
U-V	-6443 / 0	-91.8	-91.8 0.84 (1)	3.05	E-E	-957 / 0
V-D	-7094 / 0	-91.8	-91.8 0.89 (1)	2.84	M-G	-1768 / 0
D-W	-7094 / 0	-91.8	-91.8 0.89 (1)	2.84	N-H	0 / 3081
W-X	-7094 / 0	-91.8	-91.8 0.89 (1)	2.84	L-H	-433 / 44
X-Y	-7094 / 0	-91.8	-91.8 0.89 (1)	2.84	B-R	0 / 4170
Y-E	-7094 / 0	-91.8	-91.8 0.84 (1)	2.93	L-I	0 / 4108
E-Z	-7094 / 0	-91.8	-91.8 0.84 (1)	2.93		
Z-F	-7094 / 0	-91.8	-91.8 0.84 (1)	2.93		
F-AA	-7094 / 0	-91.8	-91.8 0.84 (1)	2.93		
AA-G	-7094 / 0	-91.8	-91.8 0.84 (1)	2.93		
G-AB	-6405 / 0	-91.8	-91.8 0.79 (1)	3.14		
AB-AC	-6405 / 0	-91.8	-91.8 0.79 (1)	3.14		
AC-H	-6405 / 0	-91.8	-91.8 0.79 (1)	3.14		
H-I	-4875 / 0	-91.8	-91.8 0.54 (1)	3.95		
I-J	0 / 35	-91.8	-91.8 0.07 (1)	10.00		
S-B	-3833 / 0	0.0	0.0 0.14 (1)	7.22		
K-I	-3782 / 0	0.0	0.0 0.14 (1)	7.28		

S-AD	0 / 0	-18.5	-18.5 0.07 (4)	10.00
AD-AE	0 / 0	-18.5	-18.5 0.07 (4)	10.00
AE-R	0 / 0	-18.5	-18.5 0.07 (4)	10.00
R-AF	0 / 4104	-18.5	-18.5 0.31 (1)	10.00
AF-AH	0 / 4104	-18.5	-18.5 0.31 (1)	10.00
AH-AG	0 / 4104	-18.5	-18.5 0.31 (1)	10.00
AG-AI	0 / 4104	-18.5	-18.5 0.31 (1)	10.00
AI-AJ	0 / 4104	-18.5	-18.5 0.31 (1)	10.00
AJ-AK	0 / 4104	-18.5	-18.5 0.31 (1)	10.00
AK-AL	0 / 4104	-18.5	-18.5 0.31 (1)	10.00
AL-AM	0 / 4104	-18.5	-18.5 0.31 (1)	10.00
AM-AN	0 / 4104	-18.5	-18.5 0.31 (1)	10.00
AN-AO	0 / 4104	-18.5	-18.5 0.31 (1)	10.00
AO-AP	0 / 0	-18.5	-18.5 0.07 (4)	10.00
AP-K	0 / 0	-18.5	-18.5 0.07 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2014

(85 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $\frac{1}{360}$ (1.17')
CALCULATED VERT. DEFL. (LL) = $\frac{1}{999}$ (0.19')
ALLOWABLE DEFL. (TL) = $\frac{1}{360}$ (1.17')
CALCULATED VERT. DEFL. (TL) = $\frac{1}{999}$ (0.35')

CSI: TC=0.89/1.00 (D-E:1), BC=0.48/1.00 (C-Q:1),
WB=0.52/1.00 (B-R:1), SS=0.29/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1857 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (R) (INPUT = 0.80)
JSI METAL = 0.81 (PI) (INPUT = 1.00)



Structural component only
DWG# T-2008047 1/2

CONTINUED ON PAGE 2

JOB NAME 408316	TRUSS NAME T100	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Temarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 10:08:39 2020 Page 2

ID:DMCubINV6TstFoe31v61 zns11-bU83W0TqoZcdH95325Lmslax0Me479K7VAtzqzLa9B

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW-m	MT20	6.0	9.0	Edge	
D	TMWW-l	MT20	4.0	4.0		
E	TMW-w	MT20	2.0	4.0		
F	TS-l	MT20	3.0	8.0		
G	TMWW-l	MT20	4.0	4.0		
H	TTWW-m	MT20	6.0	9.0	Edge	
I	TMVW-p	MT20	5.0	8.0	Edge	
K	BMV1-p	MT20	3.0	8.0		
L	BMWW-l	MT20	5.0	6.0	2.50	2.75
M	BMWW-l	MT20	5.0	8.0		
N	BS-l	MT20	5.0	6.0		
O	BMWW-l	MT20	5.0	8.0		
P	BS-l	MT20	5.0	6.0		
Q	BMWW-l	MT20	5.0	8.0		
R	BMWW-l	MT20	5.0	8.0	2.50	2.75
S	BMV1-p	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-542	-542	---	FRONT	VERT	TOTAL	---	C1
G	23-1-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
H	29-2-8	-542	-542	---	FRONT	VERT	TOTAL	---	C1
L	29-1-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
M	23-1-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
N	21-1-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-36	-36	---	FRONT	VERT	TOTAL	---	C1
T	7-1-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
U	9-1-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
V	11-1-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
W	13-1-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
X	15-1-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
Y	17-1-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
Z	19-1-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AA	21-1-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AB	25-1-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AC	27-1-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
AD	2-0-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AE	4-0-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AF	7-1-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AG	9-1-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AH	11-1-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AI	13-1-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AJ	15-1-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AK	17-1-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AL	19-1-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AM	25-1-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AN	27-1-12	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AO	31-0-4	-36	-36	---	FRONT	VERT	TOTAL	---	C1
AP	33-0-4	-36	-36	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2008047 7/2

Structural component only
DWG# T-2008006




Structural component only
DWG# T-2008007

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	T4	1	3	GREEN PARK HOMES	

Famarack Roof Truss, Burlington

Version 6.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 11:19:20 2020 Page 1

ID:DMCubINVR6TsiFoe31v6l_zns11-7CJlqYXU4Uo78Dz6iQJ_MvRGYYVC9phGyTLiAXzLZ45

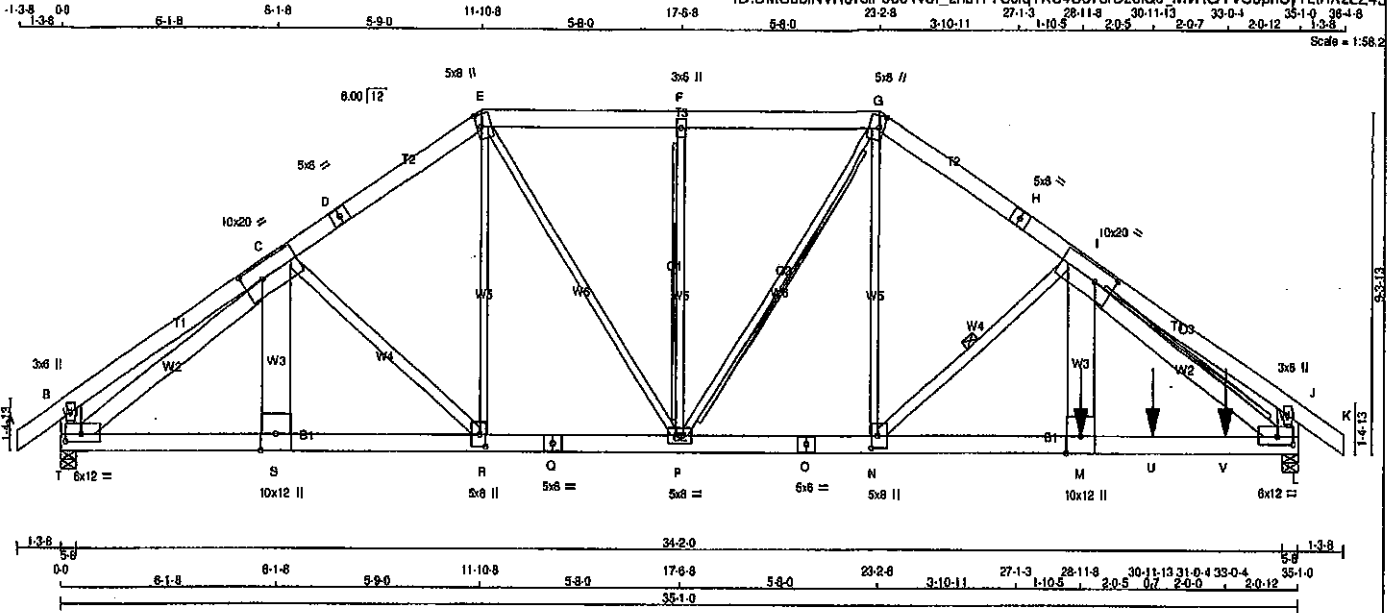

TOTAL WEIGHT = 3 X 250 = 750 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	SPF
A - D	2x8	DRY	No.2	SPF		
D - E	2x8	DRY	No.2	SPF		
E - G	2x8	DRY	No.2	SPF		
G - H	2x8	DRY	No.2	SPF		
H - K	2x8	DRY	No.2	SPF		
T - B	2x8	DRY	No.2	SPF		
L - J	2x8	DRY	No.2	SPF		
T - Q	2x8	DRY	1850F 1.5E	SPF		
Q - O	2x8	DRY	1850F 1.5E	SPF		
O - L	2x8	DRY	1850F 1.5E	SPF		

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 3 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - D	2	12
D - E	2	12
E - G	2	12
G - H	2	12
H - K	2	12
T - B	2	12
L - J	2	12
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
T - Q	2	7
Q - O	2	12
O - L	2	12
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	1	6
2x4	1	6
2x6	2	6
I - M	5	4
2x10	5	4

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
JT	VERT HORZ	DOWN HORZ	UPLIFT	W-SX IN-SX
T	4365 0	4365 0	0 0	5-8 5-8
L	14398 0	14398 0	0 0	5-8 5-8

UNFACTORED REACTIONS

	1ST LCASE	MAX./MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
T	3082	2051 / 0	0 / 0	0 / 0	0 / 0	1031 / 0	0 / 0	
L	10166	6764 / 0	0 / 0	0 / 0	0 / 0	3402 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.71 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF I-N
2x6 DRY SPF No.2 T-BRACE AT F-P, G-P, I-L

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO									
A-B	0.736	-91.8	-91.8	0.02 (1)	10.00	S-C	0.7128	0.01 (4)	
B-C	0.729	-91.8	-91.8	0.07 (1)	10.00	C-R	-33.0	0.01 (1)	
C-D	-5831.0	-91.8	-91.8	0.10 (1)	5.69	E-E	0.7122	0.01 (4)	
D-E	-5831.0	-91.8	-91.8	0.10 (1)	5.69	E-F	0.7162	0.24 (1)	
E-F	-6527.0	-91.8	-91.8	0.09 (1)	5.46	F-F	-569.0	0.09 (1)	
F-G	-6527.0	-91.8	-91.8	0.09 (1)	5.46	P-G	-2201.0	0.52 (1)	
G-H	-9190.0	-91.8	-91.8	0.17 (1)	4.71	N-G	0.7660	0.48 (1)	
H-I	-9190.0	-91.8	-91.8	0.17 (1)	4.71	N-I	-10507.0	0.94 (1)	
I-J	-8.0	-91.8	-91.8	0.10 (1)	10.00	T-C	-6246.0	0.87 (1)	
J-K	0.736	-91.8	-91.8	0.02 (1)	10.00	M-I	0.7379	0.38 (1)	
T-B	-358.0	0.0	0.0	0.01 (1)	7.81	I-L	-20028.0	0.98 (1)	
L-J	-421.0	0.0	0.0	0.01 (1)	7.81				
T-S	0.74843	-18.5	-18.5	0.14 (1)	10.00				
S-R	0.74844	-18.5	-18.5	0.13 (1)	10.00				
R-Q	0.74620	-18.5	-18.5	0.15 (1)	10.00				
Q-P	0.74620	-18.5	-18.5	0.15 (1)	10.00				
P-O	0.7715	-18.5	-18.5	0.25 (1)	10.00				
O-N	0.7715	-18.5	-18.5	0.25 (1)	10.00				
N-M	0.15707	-18.5	-18.5	0.58 (1)	10.00				
M-U	0.15528	-18.5	-18.5	0.80 (1)	10.00				
U-V	0.15528	-18.5	-18.5	0.80 (1)	10.00				
V-L	0.15528	-18.5	-18.5	0.80 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIF.	TYPE	HEEL	CONN.
M	28-11-8	-11723	-11723	---	BACK	VERT	TOTAL	---
U	31-0-4	-1458	-1458	---	BACK	VERT	TOTAL	---
V	33-0-4	-1458	-1458	---	BACK	VERT	TOTAL	---

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSI: TC=0.171/0 (G-I-I), BC=0.80/1.00 (L-M-I), WB=0.98/1.00 (I-L-I), SI=0.34/1.00 (L-M-I)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1087 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (R) (INPUT = 0.90)
JSI METAL = 0.98 (R) (INPUT = 1.00)



Structural component only
DWG# T-2008008 1/2

CONTINUED ON PAGE 2

JOB NAME 408315	TRUSS NAME T4	QUANTITY 1	PLY 3	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	----------

Pamareck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 11:19:20 2020 Page 2
ID:DMCubINVR6TstF0931vdl zns11-7CJqYXU4Up78rDz6QJ MvRGYVC9phCyTLIAKzLZ45

STAGGER NAILS BY HALF THE SURFACE SPACING IN ADJACENT PLIES.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

PLATES (tab/ats in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	8.0		
C	TMWWW-t	MT20	10.0	20.0	4.75	6.75
D	TS-l	MT20	5.0	6.0		
E	TTWW+m	MT20	5.0	8.0	4.00	1.50
F	TMW+w	MT20	3.0	6.0		
G	TTWW+m	MT20	5.0	8.0	4.00	1.50
H	TS-l	MT20	5.0	6.0		
I	TMWWW-t	MT20	10.0	20.0	4.75	6.75
J	TMV+p	MT20	3.0	6.0		
L	BMWW1-l	MT20	8.0	12.0	2.50	5.50
M	BMW+w	MT20	10.0	12.0	Edge	
N	BMWW+l	MT20	5.0	8.0	4.00	2.00
O	BS-l	MT20	5.0	6.0		
P	BMWWW-l	MT20	5.0	8.0		
Q	BS-l	MT20	5.0	6.0		
R	BMWW+l	MT20	5.0	8.0	4.00	2.00
S	BMW+w	MT20	10.0	12.0	Edge	
T	BMWW1-l	MT20	6.0	12.0	2.50	5.50

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2008008


2/2

JOB NAME 408315	TRUSS NAME T5	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	----------

Tamareck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:37 2020 Page 1

ID:DMCubINVRBTSiFoe31v61_zns1t-sqITodJT7kX9Gddq?v_YISqjGoxMrvoSGNrdzLa14

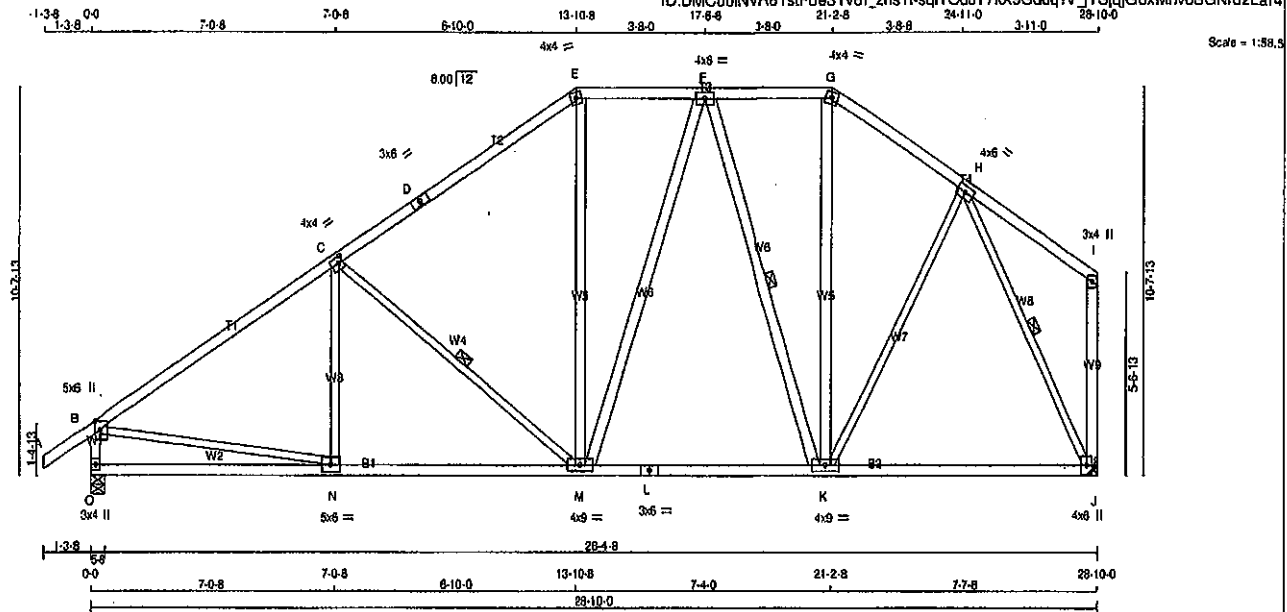

Scale = 1/8" = 1'-0"

TOTAL WEIGHT = 5 X 158 = 946 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - G	2x4	DRY	No.2	SPF	
G - I	2x4	DRY	No.2	SPF	
O - B	2x4	DRY	No.2	SPF	
J - I	2x4	DRY	No.2	SPF	
O - L	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
ALL WEBS	2x4	DRY	No.2	SPF	
EXCEPT					
N - C	2x3	DRY	No.2	SPF	
C - M	2x3	DRY	No.2	SPF	
K - H	2x3	DRY	No.2	SPF	
B - N	2x3	DRY	No.2	SPF	
H - J	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)							
JT	TYPE	PLATES	W	LEN	Y	X	
A	TMVW+p	MT20	5.0	8.0	2.75	2.00	
B	TMVW-1	MT20	4.0	4.0	2.00	1.50	
C	TS-1	MT20	3.0	8.0			
D	TTW-m	MT20	4.0	4.0			
E	TMVW-1	MT20	4.0	4.0			
F	TTW-m	MT20	4.0	4.0			
G	TMVW-1	MT20	4.0	4.0			
H	TMV-1	MT20	4.0	4.0			
I	TMV-p	MT20	3.0	4.0			
J	BMVW1+p	MT20	4.0	8.0			
K	BMVW-1	MT20	4.0	8.0			
L	BS-1	MT20	3.0	8.0			
M	BMVW-1	MT20	4.0	8.0			
N	BMVW-1	MT20	5.0	8.0			
O	BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	HORZ	DOWN	HORZ
O 1715	0	1715	0
J 1589	0	1589	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
O	1211	808 / 0	0 / 0	0 / 0	0 / 0	403 / 0	0 / 0
J	1124	738 / 0	0 / 0	0 / 0	0 / 0	388 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.08 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-M, F-K, H-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	UNBRACED LENGTH	FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	N-C	-97 / 84	0.08 (1)	
B-C	-1848 / 0	-91.8	-91.8	0.72 (1)	4.08	C-M	-807 / 0	0.34 (1)	
C-D	-1374 / 0	-91.8	-91.8	0.64 (1)	4.68	M-E	0 / 372	0.06 (1)	
D-E	-1374 / 0	-91.8	-91.8	0.64 (1)	4.68	M-F	0 / 143	0.02 (1)	
E-F	-1111 / 0	-91.8	-91.8	0.18 (1)	5.83	F-K	-572 / 0	0.37 (1)	
F-G	-881 / 0	-91.8	-91.8	0.16 (1)	6.25	K-G	0 / 322	0.05 (1)	
G-H	-1078 / 0	-91.8	-91.8	0.17 (1)	5.89	K-H	0 / 422	0.09 (1)	
H-I	0 / 22	-91.8	-91.8	0.21 (1)	10.00	G-N	0 / 1592	0.38 (1)	
O-B	-1682 / 0	0.0	0.0	0.17 (1)	6.43	H-J	-1555 / 0	0.79 (1)	
J-I	-137 / 0	0.0	0.0	0.08 (1)	7.81				
O-N	0 / 0	-18.5	-18.5	0.22 (4)	10.00				
N-M	0 / 1573	-18.5	-18.5	0.37 (1)	10.00				
M-L	0 / 1065	-18.5	-18.5	0.35 (4)	10.00				
L-K	0 / 1065	-18.5	-18.5	0.35 (4)	10.00				
K-J	0 / 687	-18.5	-18.5	0.32 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6	PSF
DL	= 6.0	PSF
BOT CH. LL	= 0.0	PSF
DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.96")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.06")
ALLOWABLE DEFL.(TL) = $L/360$ (0.96")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.12")

CSI: TC=0.72/1.00 (B-C:1), BC=0.37/1.00 (M-N:1), WB=0.79/1.00 (H-J:1), SS=0.28/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	616 354 1667 788	1967 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.77 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008009

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	T6	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 09:31:39 2020 Page 1
ID:DMCubINVR8TstFoe3tV6L_zns1t-oDPEouKJlNsVwnD7K0BdtpAf4UrqwCFmITVWzLat2

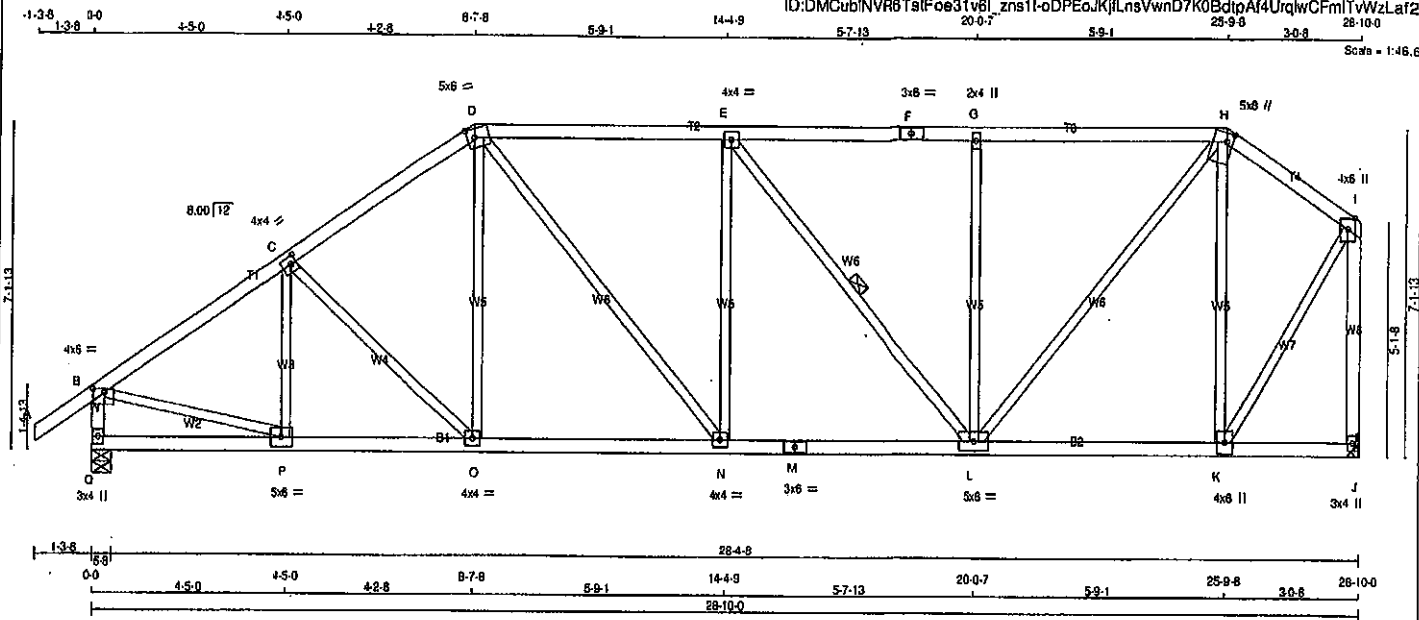

TOTAL WEIGHT = 135 lb (M)

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
O - B	2x4	DRY	No.2
J - I	2x4	DRY	No.2
Q - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (Table in Inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	8.0	1.00	3.25
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TTWW-m	MT20	5.0	8.0	2.25	2.00
E	TMVW-t	MT20	4.0	4.0		
F	TS-t	MT20	3.0	8.0		
G	TMVW-w	MT20	2.0	4.0		
H	TTWW-m	MT20	5.0	8.0	2.25	1.50
I	TMVW-p	MT20	4.0	8.0	Edge	
J	BMVt+p	MT20	3.0	4.0		
K	BMVW-t	MT20	4.0	8.0		
L	BMVWW-t	MT20	5.0	8.0		
M	BS-t	MT20	3.0	8.0		
N	BMVW-t	MT20	4.0	4.0		
O	BMVW-t	MT20	4.0	4.0		
P	BMVW-t	MT20	5.0	8.0		
Q	BMVt+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
Q	1715	0	1715	0
J	1589	0	1589	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3'-8\".

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
Q	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	1211	808 / 0	0 / 0	0 / 0	0 / 0	403 - 0	0 / 0
J	1124	738 / 0	0 / 0	0 / 0	0 / 0	388 - 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.50 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED GSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED GSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	P-C	-295 / 0	0.08 (1)	
B-C	-1814 / 0	-91.8	-91.8 0.35 (1)	C-D	-168 / 0	0.10 (1)	
C-D	-1720 / 0	-91.8	-91.8 0.33 (1)	D-E	0 / 211	0.05 (1)	
D-E	-1720 / 0	-91.8	-91.8 0.50 (1)	E-F	0 / 481	0.11 (1)	
E-F	-1484 / 0	-91.8	-91.8 0.47 (1)	F-G	-281 / 2	0.23 (1)	
F-G	-1484 / 0	-91.8	-91.8 0.47 (1)	G-H	-402 / 0	0.22 (1)	
G-H	-1484 / 0	-91.8	-91.8 0.47 (1)	H-I	-585 / 0	0.51 (1)	
H-I	-786 / 0	-91.8	-91.8 0.15 (1)	I-J	0 / 1282	0.29 (1)	
I-J	-1678 / 0	0.0	0.0 0.17 (1)	J-K	-900 / 0	0.80 (1)	
J-K	-1574 / 0	0.0	0.0 0.75 (1)	K-L	0 / 1575	0.35 (1)	
K-L	0 / 0	0.0	0.0 0.75 (1)	L-M	0 / 1191	0.27 (1)	
L-M	0 / 0	-18.5	-18.5 0.07 (4)	M-N			
M-N	0 / 1530	-18.5	-18.5 0.30 (1)	N-O			
N-O	0 / 1410	-18.5	-18.5 0.29 (1)	O-P			
O-P	0 / 1720	-18.5	-18.5 0.34 (1)	P-Q			
P-Q	0 / 1720	-18.5	-18.5 0.34 (1)	Q-R			
Q-R	0 / 639	-18.5	-18.5 0.17 (4)	R-S			
R-S	0 / 0	-18.5	-18.5 0.09 (4)	S-T			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
DL	=	6.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.96")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.07")
ALLOWABLE DEFL. (TL) = $L/360$ (0.96")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.13")

CSI: TC=0.75/1.00 (J-I), BC=0.34/1.00 (L-N:1), WB=0.80/1.00 (H-K:1), SSI=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1867 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (H) (INPUT = 0.90)
JSI METAL = 0.53 (M) (INPUT = 1.00)

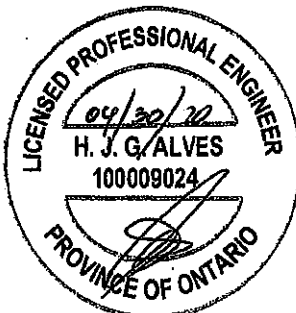


Structural component only
DWG# T-2008010

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	T7	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:40 2020 Page 1
ID:DMCubINVR6TsFos31v6l_zns11-GPzc0ILQvJ74MPg1XQA4LKZUqJ5MUQV1RyzLaf1

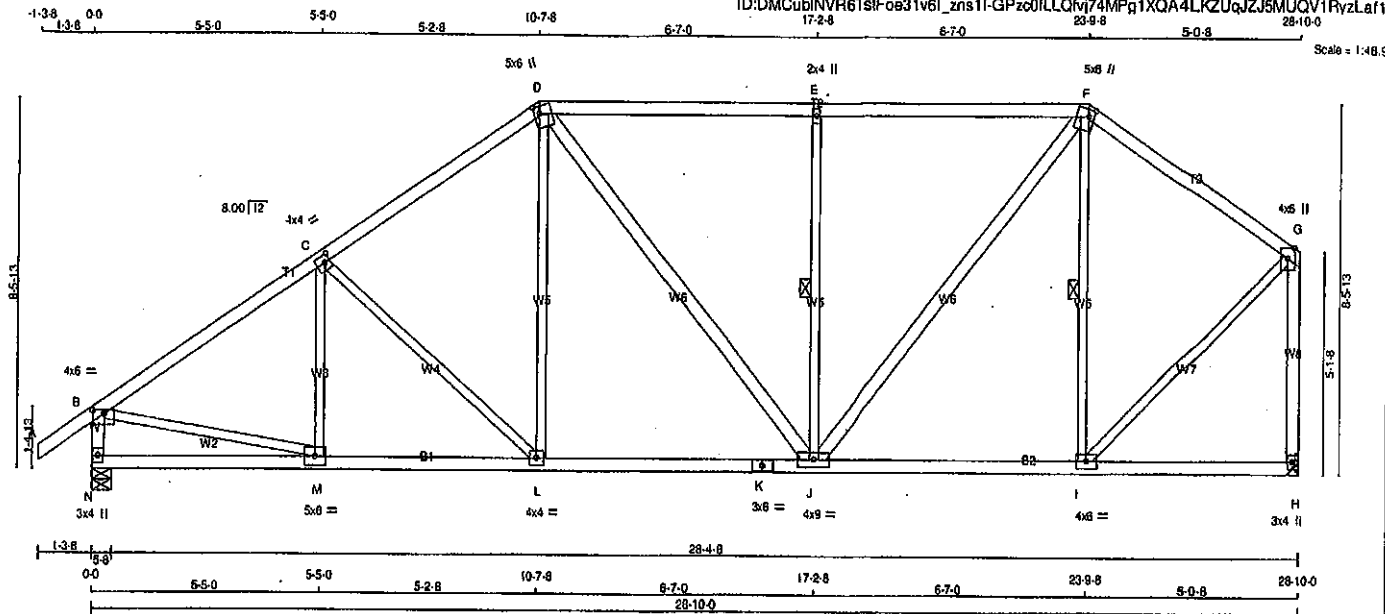

TOTAL WEIGHT = 139 lb
(M/F)

LUMBER			
N.L.G.A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
N - B	2x4	DRY	No.2
H - G	2x4	DRY	No.2
N - K	2x4	DRY	No.2
K - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - J	2x4	DRY	No.2
J - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (Tablets in Inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	4.0	8.0	1.00	3.25
C TMVW-l	MT20	4.0	4.0	2.00	1.50
D TTWW+m	MT20	5.0	8.0	2.00	1.50
E TMVW-w	MT20	2.0	4.0		
F TTWW+m	MT20	5.0	8.0	2.00	1.50
G TMVW-p	MT20	4.0	8.0	Edge	
H BMV1-p	MT20	3.0	4.0		
I BMVW-l	MT20	4.0	8.0		
J BMVWW-l	MT20	4.0	9.0		
K BS-l	MT20	3.0	6.0		
L BMVW-l	MT20	4.0	4.0		
M BMVW-l	MT20	5.0	6.0		
N BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING DESIGNER									
<u>BEARINGS</u>									
FACTORED				MAXIMUM FACTORED			INPUT	REQD.	
GROSS REACTION				GROSS REACTION			BRG	BRG	
JT	VERT	HORZ		DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
N	1715	0		1715	0	0	5-8	5-8	
H	1589	0		1589	0	0	MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
N	1211	808 / 0	0 / 0	0 / 0	0 / 0	403 / 0	0 / 0	0 / 0
H	1124	738 / 0	0 / 0	0 / 0	0 / 0	308 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.54 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

I LATERAL BRACE(S) AT 1/2 LENGTH OF E-J, F-I.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LO)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LO)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8 -91.8 0.12 (1)	10.00	M-C	-209 / 15	0.08 (1)	
B-C	-1848 / 0	-91.8 -91.8 0.39 (1)	4.54	C-L	-343 / 0	0.33 (1)	
C-D	-1808 / 0	-91.8 -91.8 0.37 (1)	4.83	L-D	0 / 338	0.08 (1)	
D-E	-1412 / 0	-91.8 -91.8 0.55 (1)	4.77	D-J	0 / 162	0.03 (1)	
E-F	-1412 / 0	-91.8 -91.8 0.55 (1)	4.77	J-E	-745 / 0	0.34 (1)	
F-G	-993 / 0	-91.8 -91.8 0.31 (1)	5.87	J-F	0 / 950	0.15 (1)	
N-B	-1672 / 0	0.0 0.0 0.17 (1)	6.42	I-F	-650 / 0	0.30 (1)	
H-G	-1554 / 0	0.0 0.0 0.74 (1)	6.61	B-M	0 / 1595	0.38 (1)	
				I-G	0 / 1129	0.25 (1)	
N-M	0 / 0	-18.5 -18.5 0.11 (4)	10.00				
M-L	0 / 1564	-18.5 -18.5 0.32 (1)	10.00				
L-K	0 / 1311	-18.5 -18.5 0.29 (1)	10.00				
K-J	0 / 1311	-18.5 -18.5 0.29 (1)	10.00				
J-I	0 / 817	-18.5 -18.5 0.23 (4)	10.00				
I-H	0 / 0	-18.5 -18.5 0.14 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
OL = 8.0 PSF
BOT CH. LL = 0.0 PSF
OL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.96")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (0.96")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CS: TC=0.74/1.00 (G-H:1), BC=0.32/1.00 (L-M:1), WB=0.39/1.00 (B-M:1), SS=0.29/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1867 788 1867 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.52 (G) (INPUT = 1.00)




Structural component only
DWG# T-2008011

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	T8	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:42 2020 Page 1

ID:DMCubINVR6TsFoe31v61_zns11-C05MRKNcxG9RMOWcoSZuFVRidHVS18sexk_8WrzLaf?

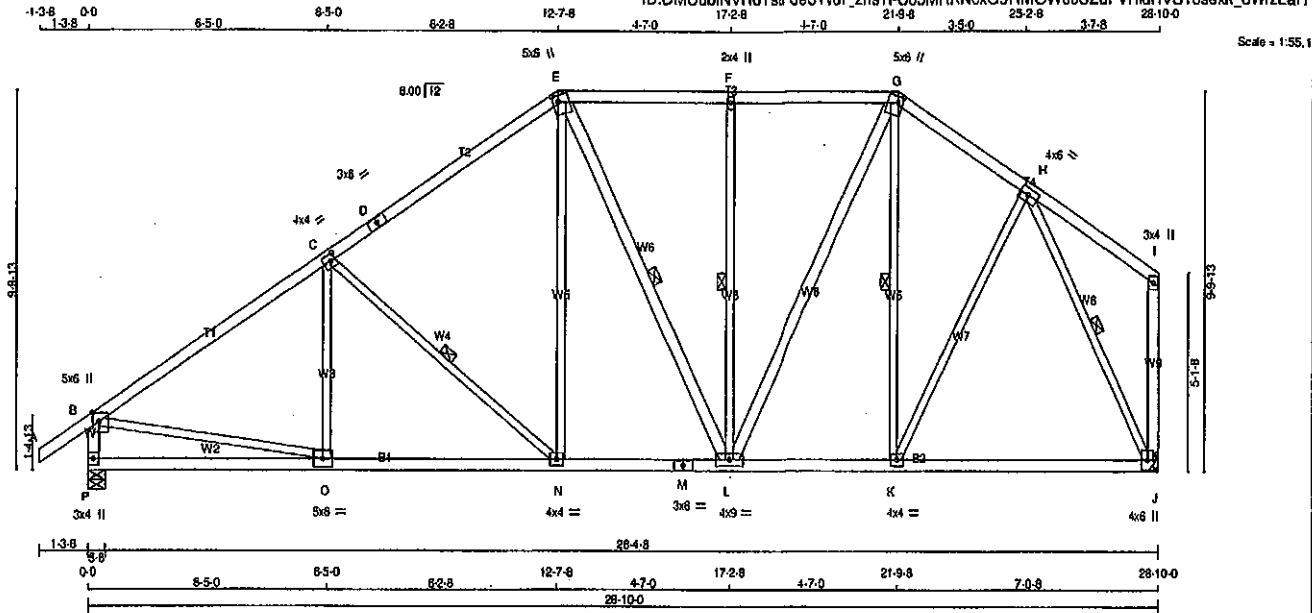

TOTAL WEIGHT = 153 lb (M/F)

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
J - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
E - L	2x4	DRY	No.2
L - G	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
P	1715	0	1715	0	5-8
J	1569	0	1569	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

1ST CASE	MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
P	1211	808 / 0	0 / 0	0 / 0	0 / 0	403 / 0	0 / 0
J	1124	738 / 0	0 / 0	0 / 0	0 / 0	368 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.29 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, E-L, F-L, G-K, H-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LOI MAX. MAX.	MEMB.	FORCE (LBS)	MAX. MAX.	CSI (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	C-C	-134 / 61	0.67 (1)
B-C	-1855 / 0	-91.8	-91.8 0.58 (1)	4.28	C-N	-510 / 0	0.24 (1)
C-D	-1487 / 0	-91.8	-91.8 0.52 (1)	4.77	N-E	0 / 435	0.10 (1)
D-E	-1487 / 0	-91.8	-91.8 0.52 (1)	4.77	E-L	-23 / 0	0.01 (1)
E-F	-1182 / 0	-91.8	-91.8 0.28 (1)	5.58	L-F	-512 / 0	0.33 (1)
F-G	-1182 / 0	-91.8	-91.8 0.28 (1)	5.58	L-G	0 / 653	0.10 (1)
G-H	-1107 / 0	-91.8	-91.8 0.15 (1)	5.85	K-G	-289 / 0	0.17 (1)
H-I	0 / 21	-91.8	-91.8 0.18 (1)	10.00	K-H	0 / 454	0.10 (1)
P-B	-1668 / 0	0.0	0.0 0.17 (1)	6.42	B-O	0 / 1598	0.36 (1)
J-I	-126 / 0	0.0	0.0 0.06 (1)	7.81	H-J	-1573 / 0	0.68 (1)
P-O	0 / 0	-18.5	-18.5 0.18 (4)	10.00			
O-N	0 / 1576	-18.5	-18.5 0.34 (1)	10.00			
N-M	0 / 1191	-18.5	-18.5 0.25 (1)	10.00			
M-L	0 / 1191	-18.5	-18.5 0.25 (1)	10.00			
L-K	0 / 899	-18.5	-18.5 0.28 (4)	10.00			
K-J	0 / 699	-18.5	-18.5 0.26 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.95")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.95")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.58/1.00 (B-C:1), BC=0.34/1.00 (N-O:1),
WB=0.68/1.00 (H-J:1), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS 6END=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLB)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1887 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (B) (INPUT = 0.90)
JSI METAL= 0.77 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008012

JOB NAME 408315	TRUSS NAME T9	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

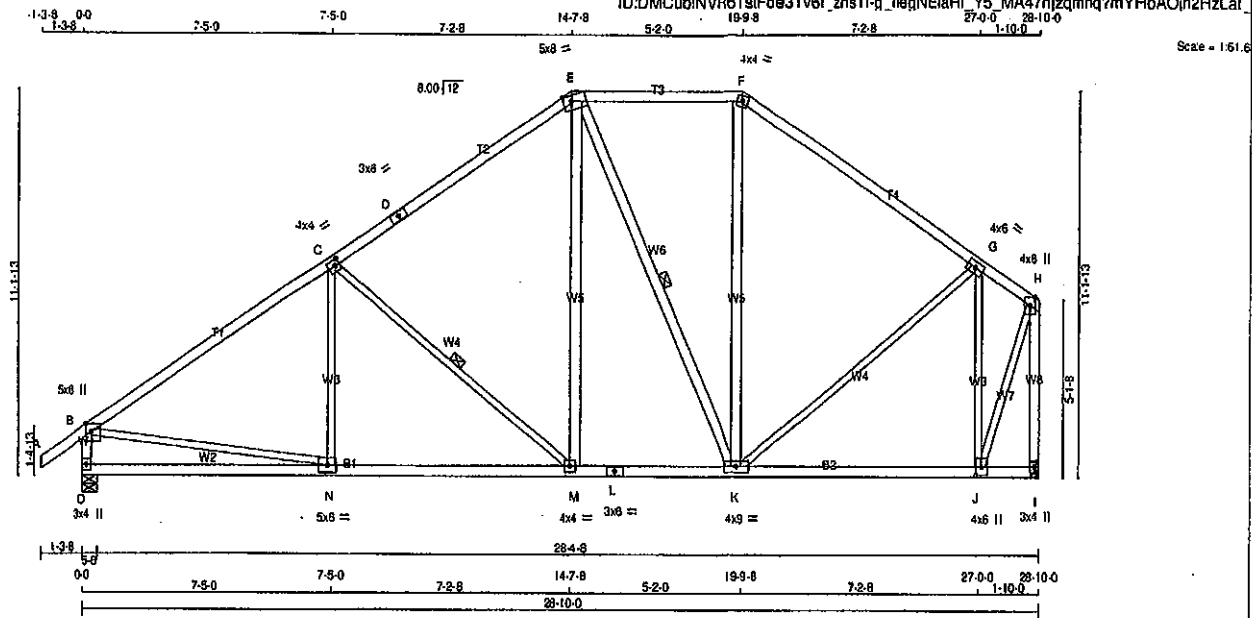

TOTAL WEIGHT = 4 X 151 = 605 lb (M/F)

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
O - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
O - L	2x4	DRY	No.2
L - I	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
M - E	2x4	DRY	No.2
E - K	2x4	DRY	No.2
K - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	5.0	8.0	2.75	2.00
C TMVW-i	MT20	4.0	4.0	2.00	1.50
D TS-i	MT20	3.0	8.0		
E TTWW-m	MT20	5.0	8.0	2.00	3.00
F TTW-m	MT20	4.0	4.0		
G TMVW-i	MT20	4.0	8.0		
H TMVW+p	MT20	4.0	8.0	Edge	
I BMV1+p	MT20	3.0	4.0		
J BMVW-i	MT20	4.0	8.0	2.75	2.00
K BMVWW-i	MT20	4.0	8.0		
L BS-i	MT20	3.0	8.0		
M BMVW-i	MT20	4.0	8.0		
N BMVW-i	MT20	5.0	8.0		
O BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	HORIZ	UPLIFT
O 1211	0	1715	0
I 1589	0	1589	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3'-8".

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
O	1211	808 / 0	0 / 0	0 / 0	0 / 0	403 / 0	0 / 0
I	1124	738 / 0	0 / 0	0 / 0	0 / 0	388 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.91 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-M, E-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	N-C	-72 / 101	0.05 (1)
B-C	-1842 / 0	-91.8	-91.8 0.81 (1)	3.91	C-M	-687 / 0	0.42 (1)
C-D	-1314 / 0	-91.8	-91.8 0.72 (1)	4.58	M-E	0 / 525	0.08 (1)
D-E	-1314 / 0	-91.8	-91.8 0.72 (1)	4.58	E-K	-335 / 0	0.27 (1)
E-F	-921 / 0	-91.8	-91.8 0.32 (1)	6.02	K-F	0 / 119	0.03 (4)
F-G	-1141 / 0	-91.8	-91.8 0.82 (1)	5.07	G-K	0 / 490	0.11 (1)
G-H	-509 / 0	-91.8	-91.8 0.49 (1)	6.25	J-G	-1297 / 0	0.84 (1)
O-B	-1680 / 0	0.0	0.0 0.17 (1)	6.44	B-N	0 / 1587	0.38 (1)
I-H	-1808 / 0	0.0	0.0 0.77 (1)	6.52	J-H	0 / 1514	0.34 (1)
O-N	0 / 0	-18.5	-18.5 0.26 (4)	10.00			
N-M	0 / 1570	-18.5	-18.5 0.39 (1)	10.00			
M-L	0 / 1081	-18.5	-18.5 0.28 (1)	10.00			
L-K	0 / 1061	-18.5	-18.5 0.26 (1)	10.00			
K-J	0 / 540	-18.5	-18.5 0.21 (4)	10.00			
J-I	0 / 0	-18.5	-18.5 0.17 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.96")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.06")
ALLOWABLE DEFL.(TL) = $L/360$ (0.96")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.14")

CS: TC=0.81/1.00 (B-C:1), BC=0.39/1.00 (M-N:1), WB=0.84/1.00 (G-J:1), SS=0.27/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.80)

JSI METAL= 0.77 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008013


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	T10	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 09:31:45 2020 Page 1

ID:DMCubNVR6TsFoe31v6l_zns11-dMmV3MPUEBX0DrEMTa7b183EvVR3EWp5eicCo6AZLasy

1-3-8 0-0 5-10-8 3-9-6 9-7-14 11-7-2 13-6-8 15-5-12 17-2-8 17-5-12 20-10-8 22-9-14 24-9-2 28-6-8 34-5-0 38-8-8 5-10-8 1-3-8
Scale = 1:56.5

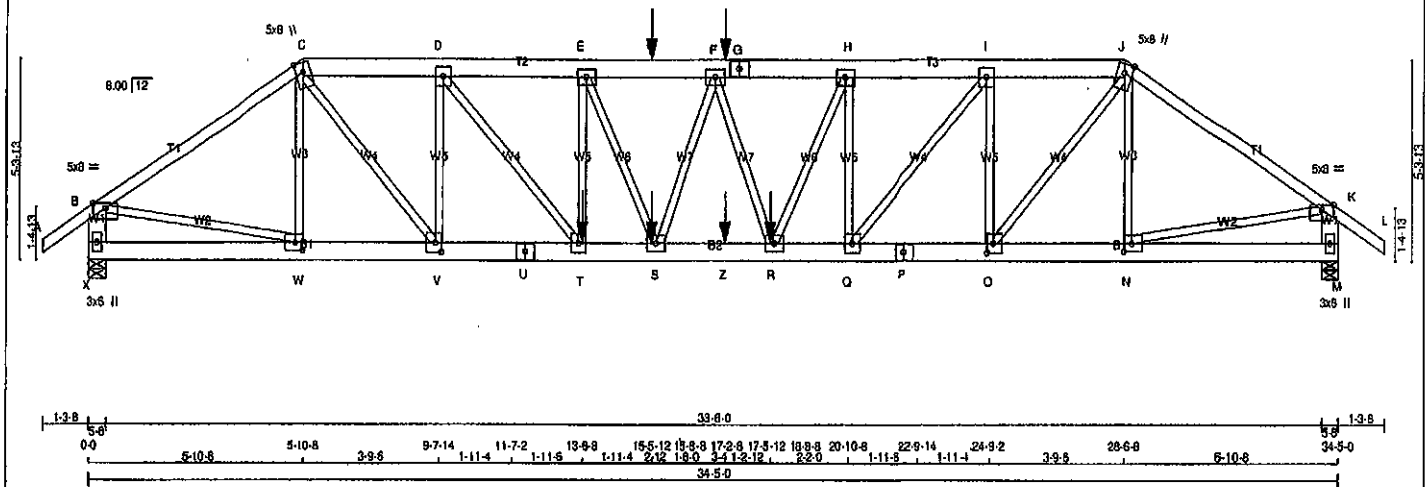

TOTAL WEIGHT = 2 X 190 = 380 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No. 2
C - G	2x6	DRY	No. 2
G - J	2x6	DRY	No. 2
J - L	2x4	DRY	No. 2
X - B	2x6	DRY	No. 2
M - K	2x6	DRY	No. 2
U - U	2x6	DRY	No. 2
U - P	2x6	DRY	No. 2
P - M	2x6	DRY	No. 2
ALL WEBS	2x3	DRY	No. 2
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
J - L	12	TOP
C - G	12	SIDE(0.0)
G - J	12	TOP
X - B	12	TOP
M - K	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
X - U	12	TOP
U - P	12	SIDE(183.1)
P - M	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
T - E	6	SIDE(237.8)
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PILES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
X	4128	0	4128	0	0	5-8	5-8	5-8	5-8
M	3945	0	3945	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
X	2908	1970	0	0	0	938	0
M	2780	1881	0	0	0	889	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) X, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.79 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	MAX. CSI (LC)
FR-TO		FROM		FR-TO			
A-B	0/35	-91.8	-91.8	0.07 (1)	10.00	W-C	-681/0
B-C	-5286/0	-91.8	-91.8	0.57 (1)	3.79	N-J	-628/0
C-D	-8808/0	-91.8	-91.8	0.13 (1)	4.48	B-W	0/4472
D-E	-9033/0	-91.8	-91.8	0.19 (1)	3.98	N-K	0/4253
E-F	-9338/0	-91.8	-91.8	0.25 (1)	3.63	S-F	-462/0
F-G	-9418/0	-91.8	-91.8	0.25 (1)	3.63	F-R	-209/0
G-H	-9418/0	-91.8	-91.8	0.20 (1)	3.87	C-H	-1127/0
H-I	-8557/0	-91.8	-91.8	0.18 (1)	4.05	R-H	0/2178
I-J	-8544/0	-91.8	-91.8	0.12 (1)	4.80	E-S	0/773
J-K	-5028/0	-91.8	-91.8	0.55 (1)	3.89	C-V	0/4063
K-L	0/35	-91.8	-91.8	0.07 (1)	10.00	V-D	-3073/0
X-B	-4074/0	0.0	0.0	0.15 (1)	7.05	D-T	0/3403
M-K	-3894/0	0.0	0.0	0.14 (1)	7.18	O-J	0/3824
X-W	0/0	-18.5	-18.5	0.04 (4)	10.00	O-I	-2988/0
W-V	0/4421	-18.5	-18.5	0.30 (1)	10.00	Q-I	0/3223
V-U	0/6906	-18.5	-18.5	0.52 (1)	10.00		
U-T	0/6908	-18.5	-18.5	0.52 (1)	10.00		
T-S	0/9033	-18.5	-18.5	0.68 (1)	10.00		
S-Z	0/9480	-18.5	-18.5	0.73 (1)	10.00		
Z-R	0/9480	-18.5	-18.5	0.73 (1)	10.00		
R-Q	0/8557	-18.5	-18.5	0.67 (1)	10.00		
Q-P	0/6544	-18.5	-18.5	0.44 (1)	10.00		
P-O	0/6544	-18.5	-18.5	0.44 (1)	10.00		
O-N	0/4204	-18.5	-18.5	0.29 (1)	10.00		
N-M	0/0	-18.5	-18.5	0.04 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
F	17-5-12	-178	-178	---	BACK	VERT	TOTAL	---
R	18-8-8	-1986	-1986	---	BACK	VERT	TOTAL	---
S	15-5-12	-36	-36	---	BACK	VERT	TOTAL	---
T	13-6-8	-1613	-1613	---	BACK	VERT	TOTAL	---
Y	15-5-12	-178	-178	---	BACK	VERT	TOTAL	---
Z	17-5-12	-36	-36	---	BACK	VERT	TOTAL	---

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2015, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.15")
CALCULATED VERT. DEFL.(LL) = L/999 (0.20")
ALLOWABLE DEFL.(TL) = L/360 (1.15")
CALCULATED VERT. DEFL.(TL) = L/999 (0.36")

CSI: TC=0.57/1.00 (B-C:1), BC=0.73/1.00 (R-S:1), WB=0.58/1.00 (D-V:1), SSI=0.10/1.00 (J-K:1)

DCL LUMBER=1.00 NAIL=1.00 LB BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1688

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (E) (INPUT = 0.90)
JSI METAL = 0.85 (U) (INPUT = 1.00)



Structural component only
DWG# T-2008014 1/2

CONTINUED ON PAGE 2

JOB NAME 408315	TRUSS NAME T10	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Famarack Roof Truss, Burlington		Version 8.310 S Oct 28 2019 Mitek Industries, Inc. Thu Apr 30 09:31:45 2020 Page 2			
		ID:DMCubINVR6TsiFos31v6I zng1I-dMmV3MPUEBX0DrEMTa7b183EvVR3EWp5aiCo8A2Lagv			

PLATES (table is in inches)


IT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	Edge	
C TTWW+m	MT20	5.0	8.0	Edge	
D TMWW+l	MT20	5.0	8.0		
E, F, H					
E TMWW-l	MT20	5.0	8.0		
G TS-l	MT20	5.0	8.0		
I TMWW+l	MT20	5.0	8.0		
J TTWW+m	MT20	5.0	8.0	Edge	
K TMVW-p	MT20	5.0	8.0	Edge	
M BMV1+p	MT20	3.0	6.0		
N BMWW-l	MT20	5.0	8.0	2.50	2.50
O BMWW+l	MT20	5.0	8.0	3.00	2.00
P BS-l	MT20	5.0	8.0		
Q BMWW+l	MT20	5.0	8.0		
R BMWW-l	MT20	5.0	8.0		
S BMWW-l	MT20	5.0	8.0		
T BMWW+l	MT20	5.0	8.0		
U BS-l	MT20	5.0	8.0		
V BMWW+l	MT20	5.0	8.0	3.00	2.00
W BMWW-l	MT20	5.0	8.0	2.50	2.50
X BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2008014

JOB NAME 408315	TRUSS NAME T11	QUANTITY 1	PLY 3	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Thu Apr 30 09:31:46 2020 Page 1	
ID:DMCubINV6TstF0e31v6i_zns11-5ZKIGiQ8?Vtr?pz1leqPLbSCvnXzvWEsMyLecziLaex				33-0-4 34-5-0 35-6-8	
1-3-8 0-0 5-5-8 6-7-8 1-2-0 5-2-2 11-11-10 5-2-14 17-2-8 5-2-14 22-5-8 5-4-2 27-9-8 28-11-8 31-0-0 1-2-0 2-0-8 2-0-8 1-1-12 1-2-0				Scale = 1:57.0	

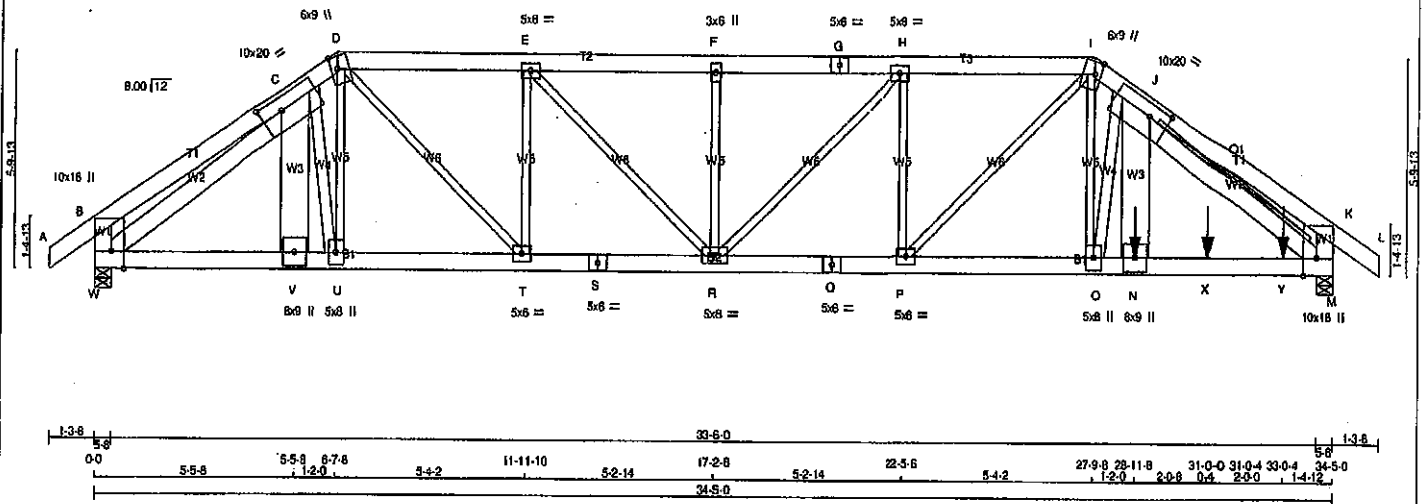

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x8 DRY	No.2	SPF		
D - G	2x6 DRY	No.2	SPF		
G - I	2x6 DRY	No.2	SPF		
I - L	2x6 DRY	No.2	SPF		
W - B	2x6 DRY	No.2	SPF		
M - K	2x6 DRY	No.2	SPF		
W - S	2x6 DRY	1650F 1.5E	SPF		
S - Q	2x6 DRY	1650F 1.5E	SPF		
Q - M	2x6 DRY	1650F 1.5E	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
EXCEPT					
V - C	2x10 DRY	No.2	SPF		
C - U	2x4 DRY	No.2	SPF		
W - C	2x6 DRY	No.2	SPF		
N - J	2x10 DRY	No.2	SPF		
O - J	2x4 DRY	No.2	SPF		
J - M	2x6 DRY	No.2	SPF		

DRY, SEASONED LUMBER.

DESIGN CONSISTS OF 3 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - D 2 12	TOP	
D - G 2 12	TOP	
G - I 2 12	TOP	
I - L 2 12	TOP	
W - B 2 12	TOP	
M - K 2 12	TOP	
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
W - S 2 5	TOP	
S - Q 2 12	TOP	
Q - M 2 5	SIDE(824.0)	
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 6		
2x4 1 6		
2x6 2 6		
J - N 5 4	SIDE(2040.4)	
2x10 5 4		

STAGGER NAILS BY HALF THE SURFACE SPACING IN ADJACENT PLIES.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
W	4072	0	4072	0	0	5-8	5-8	5-8	5-8
M	14508	0	14508	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS	WIND	DEAD	SOIL
W	2875	1913 / 0	0 / 0	0 / 0	382 / 0	0 / 0
M	10243	6815 / 0	0 / 0	0 / 0	3428 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) W, M
BEARING SIZE FACTOR = 1.15 AT JNT(S) M (BASED ON SUPPORT DEPTH = 1-8)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.59 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x6 DRY SPF No.2 T-BRACE AT J-M

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 8" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO									
A-B	0 / 36	-91.8	-91.8	0.02 (1)	10.00	V-C	-150 / 21	0.00 (1)	
B-C	0 / 15	-91.8	-91.8	0.08 (1)	10.00	C-U	0 / 321	0.02 (1)	
C-D	-548 / 0	-91.8	-91.8	0.04 (1)	5.87	U-D	-14 / 14	0.00 (1)	
D-E	-7359 / 0	-91.8	-91.8	0.09 (1)	5.22	D-T	0 / 4079	0.31 (1)	
E-F	-9618 / 0	-91.8	-91.8	0.10 (1)	4.69	T-E	-2016 / 0	0.42 (1)	
F-G	-9618 / 0	-91.8	-91.8	0.10 (1)	4.69	E-R	0 / 3233	0.24 (1)	
G-H	-9618 / 0	-91.8	-91.8	0.10 (1)	4.69	R-F	-447 / 0	0.07 (1)	
H-I	-11353 / 0	-91.8	-91.8	0.14 (1)	4.35	F-H	-2481 / 0	0.87 (1)	
I-J	-15043 / 0	-91.8	-91.8	0.35 (1)	3.59	H-P	0 / 1284	0.10 (1)	
J-K	-114 / 0	-91.8	-91.8	0.25 (1)	6.25	P-I	-1775 / 0	0.63 (1)	
K-L	0 / 36	-91.8	-91.8	0.02 (1)	10.00	O-I	0 / 8839	0.86 (1)	
W-B	-349 / 0	0.0	0.0	0.01 (1)	7.81	W-C	-5708 / 0	0.60 (1)	
M-K	-580 / 0	0.0	0.0	0.01 (1)	7.81	N-J	0 / 13381	0.37 (1)	
						O-J	-9338 / 0	0.85 (1)	
V-U	0 / 4381	-18.5	-18.5	0.13 (1)	10.00	J-M	-19292 / 0	0.79 (1)	
W-U	0 / 4377	-18.5	-18.5	0.13 (1)	10.00				
U-T	0 / 4472	-18.5	-18.5	0.14 (1)	10.00				
T-S	0 / 7359	-18.5	-18.5	0.20 (1)	10.00				
S-R	0 / 7359	-18.5	-18.5	0.20 (1)	10.00				
R-Q	0 / 11353	-18.5	-18.5	0.30 (1)	10.00				
Q-P	0 / 11353	-18.5	-18.5	0.30 (1)	10.00				
P-O	0 / 12609	-18.5	-18.5	0.38 (1)	10.00				
O-N	0 / 15181	-18.5	-18.5	0.48 (1)	10.00				
N-X	0 / 14810	-18.5	-18.5	0.72 (1)	10.00				
X-Y	0 / 14810	-18.5	-18.5	0.72 (1)	10.00				
Y-M	0 / 14810	-18.5	-18.5	0.72 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
N	28-11-8	-11812	-11812		FRONT	VERT	TOTAL		C1
X	31-0-4	-1456	-1456		FRONT	VERT	TOTAL		C1
Y	33-0-4	-1456	-1456		FRONT	VERT	TOTAL		C1

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.15")
CALCULATED VERT. DEFL.(LL) = U/999 (0.13")
ALLOWABLE DEFL.(TL) = L/360 (1.15")
CALCULATED VERT. DEFL.(TL) = U/999 (0.24")

CSI: TC=0.35/1.00 (N:1), BC=0.72/1.00 (M:N:1),
WB=0.87/1.00 (H-R:1), SS=0.31/1.00 (M-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (I) (INPUT = 0.90)
JSI METAL= 0.92 (N) (INPUT = 1.00)

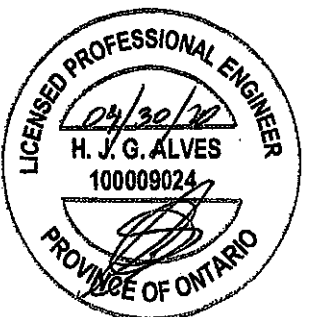

Structural component only
DWG# T-2008015

JOB NAME 408315	TRUSS NAME T11	QUANTITY 1	PLY 3	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:31:48 2020 Page 2

ID:DMCubINVR6TstFoe31v6I_zns1t-5ZKIGKQ6?Vfir7pZ1eqPLbSCvnXzyWEsMylLeczLaex

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B, K, M, W						
B						
B	TMBMWV1*	pMT20	10.0	16.0	Edge	4.50
C	TMWWVW-1	MT20	10.0	20.0	4.00	6.75
D	TTWW+m	MT20	8.0	9.0	4.00	2.00
E	TMWW-1	MT20	5.0	6.0		
F	TMW+w	MT20	3.0	6.0		
G	TS-1	MT20	5.0	6.0		
H	TMWW-1	MT20	5.0	6.0		
I	TTWW+m	MT20	8.0	9.0	4.00	2.00
J	TMWWVW-1	MT20	10.0	20.0	4.00	6.75
M	TMBMWV1*	pMT20	10.0	16.0	Edge	4.50
N	BMW+w	MT20	8.0	9.0		
O	BMWW+1	MT20	5.0	6.0		
P	BMWW-1	MT20	5.0	6.0		
Q	BS-1	MT20	5.0	6.0		
R	BMWWVW-1	MT20	5.0	6.0		
S	BS-1	MT20	5.0	6.0		
T	BMWW-1	MT20	5.0	6.0		
U	BMWW+1	MT20	5.0	6.0		
V	BMW+w	MT20	8.0	9.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2008016

JOB NAME 408315	TRUSS NAME T12	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	ORWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:48 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-xShORNX6vb4Jzx8jgUmhliITRpxXKqRSjVzLaos

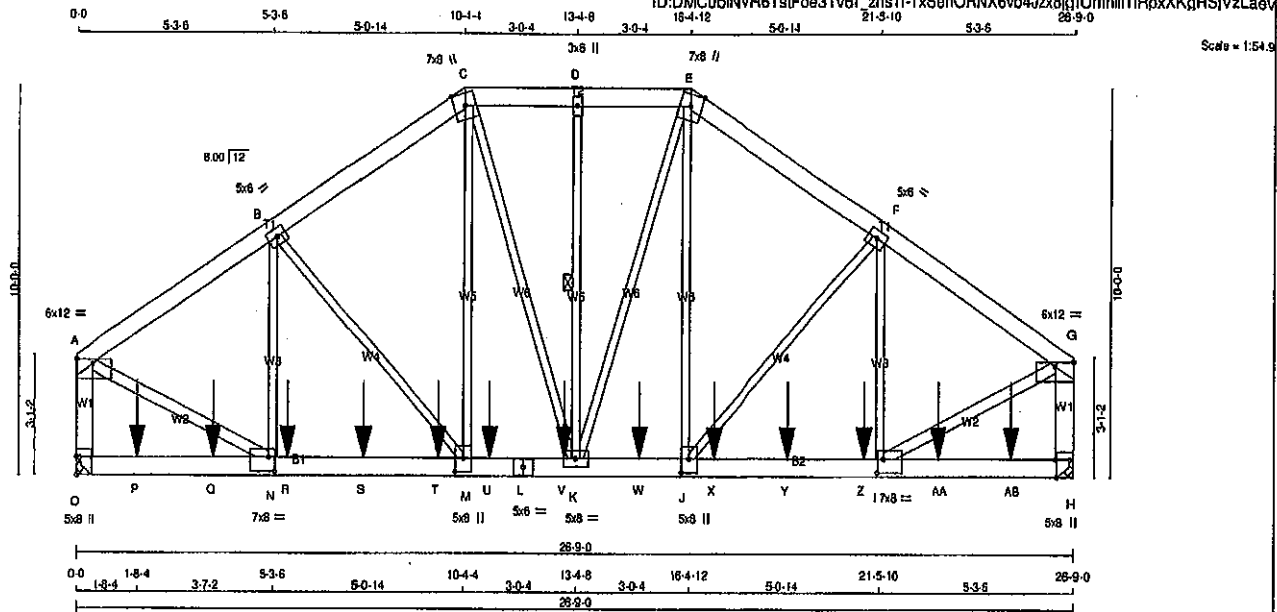

TOTAL WEIGHT = 2 X 184 = 369 lb

CHORDS	SIZE	LUMBER	DESCR
A - C	2x6	DRY No.2	SPF
C - E	2x6	DRY No.2	SPF
E - G	2x6	DRY No.2	SPF
O - A	2x6	DRY No.2	SPF
H - G	2x6	DRY No.2	SPF
O - L	2x6	DRY 2100F 1.8E	SPF
L - H	2x6	DRY 2100F 1.8E	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF
A - N	2x4	DRY No.2	SPF
I - G	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C 2	12	TOP
C-E 2	12	TOP
E-G 2	12	TOP
O-A 2	12	TOP
H-G 2	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
O-L 2	12	SIDE(0.0)
L-H 2	12	SIDE(197.8)
WEBS: (0.122"x3") SPIRAL NAILS		
D-K 1	8	SIDE(212.1)
2x3 1	8	
2x4 1	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED RANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	RECORD
JT VERT	HORZ	DOWN	HORZ
O 11741	0	11741	0
H 11631	0	11631	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT O, H. MINIMUM BEARING LENGTH AT JOINT O = 5-0, JOINT H = 5-0.

UNFACTORED REACTIONS

1ST LOASE	MAX/MIN	COMPONENT REACTIONS					
JT COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
O 8292	5505/0	0/0	0/0	0/0	2787/0	0/0	
H 8214	5453/0	0/0	0/0	0/0	2781/0	0/0	

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.56 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED	MAX. FACTORED
FR-TO			FROM	TO	CS1 (LC)	FR-TO	FROM	TO
A-B	-10728/0	-91.8	-91.8	0.30 (1)	3.56	N-B	0/1483	0.06 (1)
B-C	-10099/0	-91.8	-91.8	0.28 (1)	3.69	B-M	-858/0	0.55 (1)
C-D	-8728/0	-91.8	-91.8	0.16 (1)	4.02	M-C	0/14208	0.52 (1)
D-E	-8728/0	-91.8	-91.8	0.16 (1)	4.02	C-K	0/11003	0.12 (1)
E-F	-9982/0	-91.8	-91.8	0.28 (1)	3.72	K-D	-70/124	0.02 (1)
F-G	-10812/0	-91.8	-91.8	0.29 (1)	3.59	K-E	0/13399	0.17 (1)
O-A	-10585/0	0.0	0.0	0.54 (1)	4.64	J-E	0/13755	0.46 (1)
H-G	-10453/0	0.0	0.0	0.53 (1)	4.66	J-F	-887/0	0.57 (1)
						I-F	0/515	0.06 (1)
O-P	0/0	-18.5	-18.5	0.44 (1)	10.00	A-N	0/9949	0.88 (1)
P-Q	0/0	-18.5	-18.5	0.44 (1)	10.00	I-G	0/9843	0.87 (1)
Q-N	0/0	-18.5	-18.5	0.44 (1)	10.00			
N-R	0/8933	-18.5	-18.5	0.67 (1)	10.00			
R-S	0/8933	-18.5	-18.5	0.87 (1)	10.00			
S-T	0/8933	-18.5	-18.5	0.67 (1)	10.00			
T-M	0/8933	-18.5	-18.5	0.67 (1)	10.00			
M-U	0/8425	-18.5	-18.5	0.42 (1)	10.00			
U-L	0/8425	-18.5	-18.5	0.42 (1)	10.00			
L-V	0/8425	-18.5	-18.5	0.42 (1)	10.00			
V-K	0/8425	-18.5	-18.5	0.42 (1)	10.00			
K-W	0/8305	-18.5	-18.5	0.43 (1)	10.00			
W-J	0/8305	-18.5	-18.5	0.43 (1)	10.00			
J-X	0/8837	-18.5	-18.5	0.67 (1)	10.00			
X-Y	0/8837	-18.5	-18.5	0.67 (1)	10.00			
Y-Z	0/8837	-18.5	-18.5	0.67 (1)	10.00			
Z-I	0/8837	-18.5	-18.5	0.67 (1)	10.00			
I-AA	0/0	-18.5	-18.5	0.44 (1)	10.00			
AA-AB	0/0	-18.5	-18.5	0.44 (1)	10.00			
AB-H	0/0	-18.5	-18.5	0.44 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)								
JT LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
P	1-8-4	-1571	-1571	---	BACK	VERT	TOTAL	---
Q	3-8-4	-1571	-1571	---	BACK	VERT	TOTAL	---
R	5-8-4	-1571	-1571	---	BACK	VERT	TOTAL	---
S	7-8-4	-1571	-1571	---	BACK	VERT	TOTAL	---

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GIG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.89")
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (0.89")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CS: TC=0.54/1.00 (A-O-1), BC=0.67/1.00 (M-N-1), WB=0.88/1.00 (A-N-1), SS=0.93/1.00 (M-N-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRP= 0.89 (1) (INPUT = 0.90)
JSI METAL= 0.84 (1) (INPUT = 1.00)



Structural component only
DWG# T-2008017 1/2

CONTINUED ON PAGE 2

JOB NAME 408315	TRUSS NAME T12	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Thu Apr 30 09:31:46 2020 Page 2
ID:DMCubINVR8TslFoe31v6l zns1f-1xSehORNX6vb4Jzx8igIUmhTTRoxXKqRSIVzLaev

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWW-p	MT20	6.0	12.0	1.50	Edge
B	TMWW-l	MT20	5.0	8.0		
C	TTWW+m	MT20	7.0	8.0	Edge	
D	TMWW-w	MT20	3.0	6.0		
E	TTWW+m	MT20	7.0	8.0	Edge	
F	TMWW-l	MT20	6.0	6.0		
G	TMWW-p	MT20	6.0	12.0	1.50	Edge
H	BMV1+l	MT20	5.0	8.0	Edge	0.50
I	BMWW-l	MT20	7.0	8.0	4.25	2.00
J	BMWW+l	MT20	5.0	8.0	4.25	2.50
K	BMWWW-l	MT20	5.0	8.0		
L	BS-l	MT20	5.0	6.0		
M	BMWW+l	MT20	5.0	8.0	4.25	2.50
N	BMWW-l	MT20	7.0	8.0	4.25	2.00
O	BMV1+l	MT20	5.0	8.0	5.50	


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)


JT	LOC.	LC1	MAX	MAX*	FACE	DIR.	TYPE	HEEL	CONN.
T	9-8-4	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
U	11-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
V	13-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
W	15-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
X	17-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
Y	19-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
Z	21-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
AA	23-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
AB	25-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

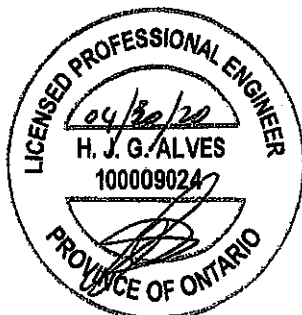

Structural component only
DWG# T-2008017 7/2

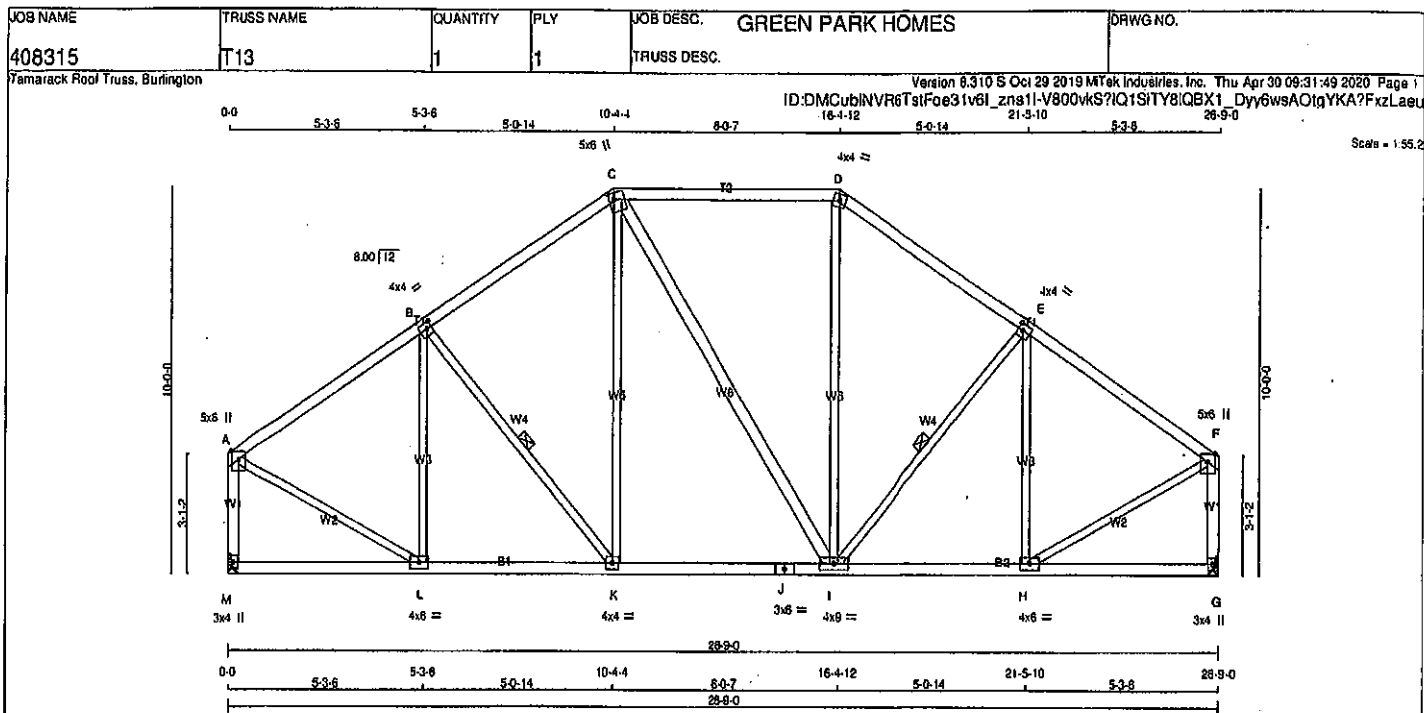

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
M - A	2x4	DRY No.2	SPF
G - F	2x4	DRY No.2	SPF
M - J	2x4	DRY No.2	SPF
J - G	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			
C - I	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	5.0	6.0	Edge	
B	TMVW-t	MT20	4.0	4.0	2.00	1.50
C	TTWW+m	MT20	5.0	6.0	2.00	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMVW-t	MT20	4.0	4.0	2.00	1.50
F	TMVW+p	MT20	5.0	6.0	Edge	
G	BMV1+p	MT20	3.0	4.0		
H	BMVW-t	MT20	4.0	6.0		
I	BMVW-t	MT20	4.0	9.0		
J	BS-t	MT20	3.0	6.0		
K	BMVW-t	MT20	4.0	4.0		
L	BMVW-t	MT20	4.0	6.0		
M	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
M	1475	0	1475	0	0	MECHANICAL	MECHANICAL
G	1475	0	1475	0	0	MECHANICAL	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT M, G. MINIMUM BEARING LENGTH AT JOINT M = 3-8, JOINT G = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	1043	884 / 0	0 / 0	0 / 0	0 / 0	358 / 0	0 / 0
G	1043	884 / 0	0 / 0	0 / 0	0 / 0	358 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.39 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF B-K, E-I.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	-1227 / 0	-91.8 -91.8	0.34 (1)	5.99	L-B	-445 / 0	0.32 (1)
B-C	-1198 / 0	-91.8 -91.8	0.34 (1)	5.44	B-K	-124 / 0	0.08 (1)
C-D	-971 / 0	-91.8 -91.8	0.44 (1)	5.70	K-C	0 -197	0.05 (4)
D-E	-1199 / 0	-91.8 -91.8	0.34 (1)	5.44	C-I	0 / 0	0.00 (1)
E-F	-1227 / 0	-91.8 -91.8	0.34 (1)	5.39	I-D	0 / 198	0.05 (1)
M-A	-1434 / 0	0.0 0.0	0.24 (1)	6.82	I-E	-124 / 0	0.08 (1)
G-F	-1434 / 0	0.0 0.0	0.24 (1)	6.82	H-E	-445 / 0	0.32 (1)
M-L	0 / 0	-18.5 -18.5	0.12 (4)	10.00	A-L	0 / 1183	0.27 (1)
L-K	0 / 1047	-18.5 -18.5	0.23 (1)	10.00	H-F	0 / 1183	0.27 (1)
K-J	0 / 971	-18.5 -18.5	0.22 (1)	10.00			
J-I	0 / 971	-18.5 -18.5	0.22 (1)	10.00			
I-H	0 / 1047	-18.5 -18.5	0.23 (1)	10.00			
H-G	0 / 0	-18.5 -18.5	0.11 (4)	10.00			

TOTAL WEIGHT = 132 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2010
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.89")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.04")
ALLOWABLE DEFL.(TL) = $L/360$ (0.89")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.08")

CSI: TC=0.44/1.00 (C-D:1), BC=0.23/1.00 (H-I:1),
WB=0.32/1.00 (E-H:1), SS=0.22/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (A) (INPUT = 0.90)
JSI METAL = 0.50 (A) (INPUT = 1.00)




Structural component only
DWG# T-2008018

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408315	T14S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Thu Apr 30 09:31:50 2020 Page 1

ID:DMCubINVR6tsiFoe31v6l_zns11-zKa0B4Td3j9Kc7KG8imaBm6aWFlvskn_wZnNzLaet

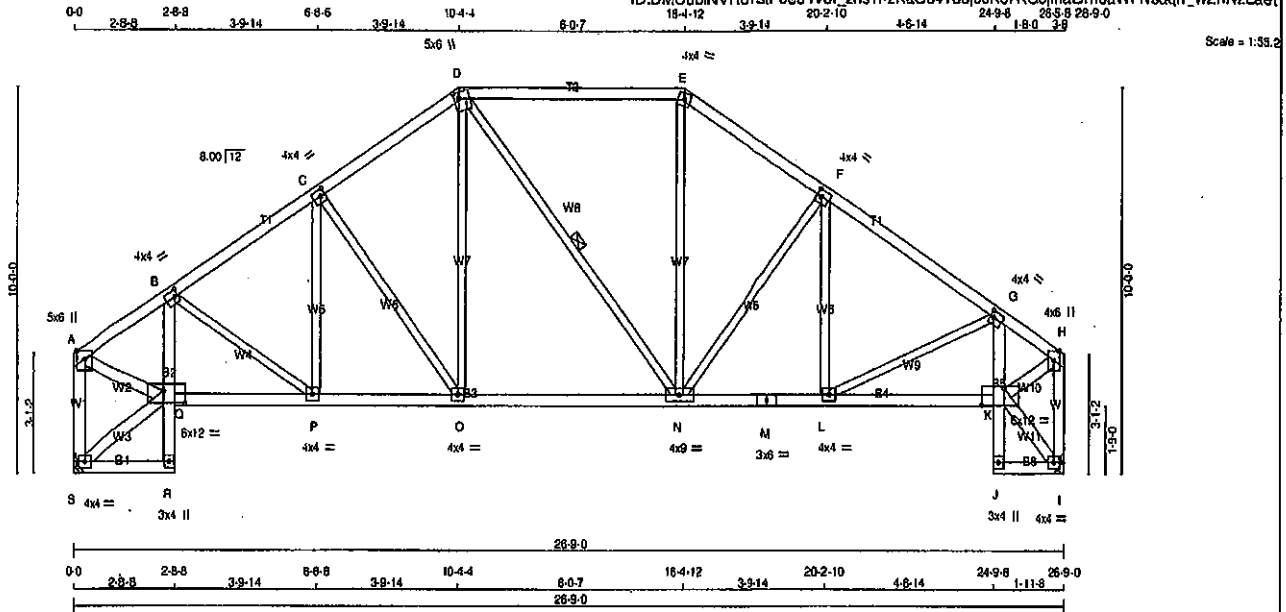

TOTAL WEIGHT = 138 lb
(M/F)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - H	2x4	DRY	No.2	SPF	
S - A	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
S - R	2x4	DRY	No.2	SPF	
R - B	2x4	DRY	No.2	SPF	
Q - M	2x4	DRY	No.2	SPF	
M - K	2x4	DRY	No.2	SPF	
J - G	2x4	DRY	No.2	SPF	
J - I	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	
S - Q	2x4	DRY	No.2	SPF	
A - Q	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
K - H	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-p	MT20	5.0	6.0	Edge	
B	TMVW-1	MT20	4.0	4.0	2.00	1.00
C	TMVW-1	MT20	4.0	4.0	2.00	1.50
D	TMVW-m	MT20	5.0	6.0	2.00	1.50
E	TMVW-m	MT20	4.0	4.0		
F	TMVW-1	MT20	4.0	4.0	2.00	1.50
G	TMVW-1	MT20	4.0	4.0	2.00	1.00
H	TMVW-p	MT20	4.0	6.0	Edge	
I	BMVW-1	MT20	4.0	4.0		
J	BMV-p	MT20	3.0	4.0		
K	BMVW-4	MT20	6.0	12.0	5.25	7.25
L, O, P						
L	BMVW-1	MT20	4.0	4.0		
M	BS-1	MT20	3.0	6.0		
N	BMVW-4	MT20	4.0	9.0		
Q	BMVW-4	MT20	6.0	12.0	3.75	7.00
R	BMV-p	MT20	3.0	4.0		
S	BMVW-1	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED			MAXIMUM FACTORED			INPUT	REQD
GROSS REACTION			GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
S	1475	0	1475	0	0	MECHANICAL	
I	1475	0	1475	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT S, I. MINIMUM BEARING LENGTH AT JOINT S = 3-8, JOINT I = 3-8.

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1043	884 / 0	0 / 0	0 / 0	0 / 0	358 / 0	0 / 0
I	1043	884 / 0	0 / 0	0 / 0	0 / 0	358 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.94 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CS1 (LC)	UNBRACED LENGTH FR-TO	FR-TO	FR-TO	MEMB.	FORCE (LBS)	MAX	CS1 (LC)
A-B	-1511 / 0	-91.8	-91.8	0.11 (1)	5.25	B-P	0 / 124	0.03 (1)		
B-C	-1853 / 0	-91.8	-91.8	0.19 (1)	4.59	P-Q	0 / 55	0.02 (4)		
C-D	-1440 / 0	-91.8	-91.8	0.18 (1)	5.28	Q-R	-345 / 0	0.28 (1)		
D-E	-1184 / 0	-91.8	-91.8	0.45 (1)	5.28	Q-D	0 / 375	0.08 (1)		
E-F	-1445 / 0	-91.8	-91.8	0.21 (1)	5.23	D-N	0 / 0	0.00 (1)		
F-G	-1884 / 0	-91.8	-91.8	0.22 (1)	4.94	N-E	0 / 383	0.09 (1)		
G-H	-1355 / 0	-91.8	-91.8	0.14 (1)	5.43	N-F	-357 / 0	0.29 (1)		
S-A	-1442 / 0	0.0	0.0	0.24 (1)	6.81	L-F	-24 / 54	0.02 (4)		
I-H	-1444 / 0	0.0	0.0	0.24 (1)	6.80	L-G	0 / 244	0.05 (1)		
						S-Q	-16 / 0	0.00 (1)		
S-R	0 / 13	-18.5	-18.5	0.04 (4)	10.00	A-Q	0 / 1370	0.22 (1)		
R-Q	0 / 27	0.0	0.0	0.03 (1)	10.00	K-I	-20 / 0	0.00 (1)		
Q-B	-460 / 0	0.0	0.0	0.03 (1)	7.81	K-H	0 / 1330	0.21 (1)		
Q-P	0 / 1280	-18.5	-18.5	0.25 (1)	10.00					
P-O	0 / 1383	-18.5	-18.5	0.28 (1)	10.00					
O-N	0 / 1184	-18.5	-18.5	0.25 (1)	10.00					
N-M	0 / 1390	-18.5	-18.5	0.28 (1)	10.00					
M-L	0 / 1390	-18.5	-18.5	0.28 (1)	10.00					
L-K	0 / 1169	-18.5	-18.5	0.24 (1)	10.00					
J-K	0 / 19	0.0	0.0	0.04 (1)	10.00					
K-G	-613 / 0	0.0	0.0	0.03 (1)	7.81					
J-I	0 / 15	-18.5	-18.5	0.02 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPK 2011, TPIC 2014

(85% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.89")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.89")
CALCULATED VERT. DEFL.(TL) = L/999 (0.10")

CSK TC=0.45/1.00 (D-E:1), BC=0.28/1.00 (L-N:1), WB=0.28/1.00 (F-N:1), SS=0.22/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (G) (INPUT = 0.80)

JSI METAL= 0.84 (H) (INPUT = 1.00)

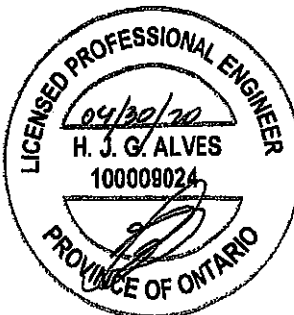

Structural component only
DWG# T-2008019

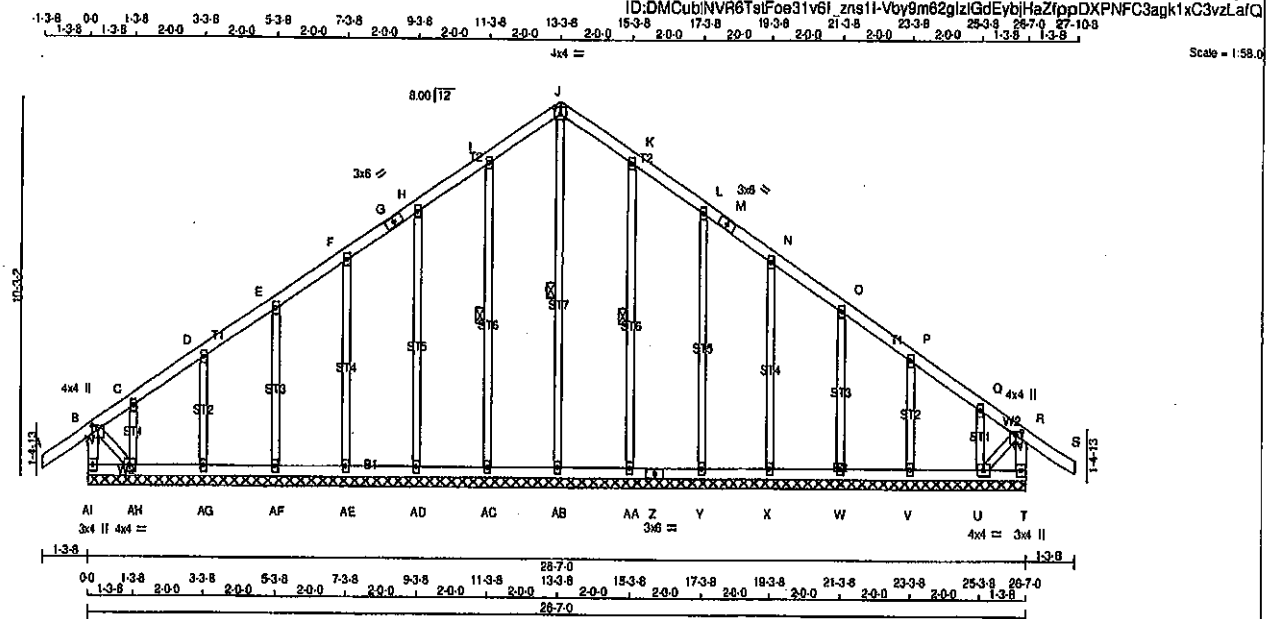

TOTAL WEIGHT = 132 lb

LUMBER			
N. L. G. A.	RULES		
CHORDS	SIZE	LUMBER	DESCR.
A - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
J - M	2x4	DRY	No.2
M - S	2x4	DRY	No.2
Al - B	2x4	DRY	No.2
T - R	2x4	DRY	No.2
Al - Z	2x4	DRY	No.2
Z - T	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS			
	2x3	DRY	No.2
DRY: SEASONED LUMBER.			
GABLE STUDS SPACED AT 2-0-0 CC.			

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+ ^p	MT20	4.0	4.0	1.25	2.00
C, D, E, F, H, I, K, L, N, P, Q, R						
G	TMV+ ^w	MT20	2.0	4.0		
C	TS-1	MT20	3.0	6.0		
J	TTW-p	MT20	4.0	4.0	2.25	2.00
M	TS-1	MT20	3.0	6.0		
R	TMVW+ ^p	MT20	4.0	4.0	1.25	2.00
T	BMV1+ ^p	MT20	3.0	4.0		
U	BMVW1+ ^t	MT20	4.0	4.0		
V, W, X, Y, AA, AB, AC, AD, AE, AF, AG						
Z	BMV1+ ^w	MT20	2.0	4.0		
V	BS-1	MT20	3.0	6.0		
AI	BMVW1+ ^t	MT20	4.0	4.0		
AH	BMV1+ ^p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF J-AB, I-AC, K-AA.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBB				
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)		
FR-TO		FROM TO			FR-TO				
A-B	0/35	-91.8	-91.8	0.12 (1)	10.00	AB-J	-139/0	0.10 (1)	
B-C	-70/0	-91.8	-91.8	0.12 (1)	8.25	AC-I	-208/0	0.11 (1)	
C-D	-24/0	-91.8	-91.8	0.05 (1)	8.25	AD-H	-177/0	0.19 (1)	
D-E	-27/0	-91.8	-91.8	0.05 (1)	8.25	AE-F	-183/0	0.11 (1)	
E-F	-21/0	-91.8	-91.8	0.04 (1)	8.25	AF-E	-178/0	0.06 (1)	
F-G	-19/0	-91.8	-91.8	0.04 (1)	8.25	AG-D	-195/0	0.04 (1)	
G-H	-19/0	-91.8	-91.8	0.04 (1)	8.25	AH-C	-70/0	0.04 (1)	
H-I	-14/0	-91.8	-91.8	0.05 (1)	8.25	AA-K	-208/0	0.11 (1)	
I-J	-24/0	-91.8	-91.8	0.05 (1)	8.25	Y-L	-177/0	0.19 (1)	
J-K	-24/0	-91.8	-91.8	0.05 (1)	8.25	X-N	-183/0	0.11 (1)	
K-L	-14/0	-91.8	-91.8	0.05 (1)	8.25	W-O	-178/0	0.06 (1)	
L-M	-19/0	-91.8	-91.8	0.04 (1)	8.25	V-P	-195/0	0.04 (1)	
M-N	-19/0	-91.8	-91.8	0.04 (1)	8.25	U-Q	-70/0	0.01 (1)	
N-O	-21/0	-91.8	-91.8	0.04 (1)	8.25	BA-H	0/38	0.01 (1)	
O-P	-27/0	-91.8	-91.8	0.05 (1)	8.25	UR	0/38	0.01 (1)	
P-Q	-24/0	-91.8	-91.8	0.05 (1)	8.25				
Q-R	-70/0	-91.8	-91.8	0.12 (1)	8.25				
R-S	0/35	-91.8	-91.8	0.12 (1)	10.00				
AI-B	-288/0	0.0	0.0	0.03 (1)	7.81				
T-R	-288/0	0.0	0.0	0.03 (1)	7.81				

AI-AH	0 0	-18.5	-18.5	0.01 (4)	10.00
AH-AG	0 26	-18.5	-18.5	0.02 (4)	10.00
AG-AF	0 21	-18.5	-18.5	0.02 (4)	10.00
AF-AE	0 18	-18.5	-18.5	0.02 (4)	10.00
AE-AD	0 15	-18.5	-18.5	0.02 (4)	10.00
AD-AC	0 13	-18.5	-18.5	0.02 (4)	10.00
AC-AB	0 11	-18.5	-18.5	0.01 (4)	10.00
AB-AA	0 11	-18.5	-18.5	0.01 (4)	10.00
AA-Z	0 13	-18.5	-18.5	0.02 (4)	10.00
Z-Y	0 13	-18.5	-18.5	0.02 (4)	10.00
Y-X	0 15	-18.5	-18.5	0.02 (4)	10.00
X-W	0 18	-18.5	-18.5	0.02 (4)	10.00
W-V	0 21	-18.5	-18.5	0.02 (4)	10.00
V-U	0 26	-18.5	-18.5	0.02 (4)	10.00
U-T	0 0	-18.5	-18.5	0.01 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018 , OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.0 (A-B:1) , SC=0.02/1.0 (AG-AH:4) , WB=0.19/1.0 (L-Y:1) , BB=0.08/1.0 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1667 788	1907 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.49 (U) (INPUT = 0.90)
JSI METAL= 0.11 (K) (INPUT = 1.00)




Structural component only
DWG# T-2007993

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	T16	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 09:31:52 2020 Page 1

ID:DMCubINVR6TsFoe31v6I_zns11-wj8XUibLQqZwhINyIEtrX1JyQn77FIPisGzLaE

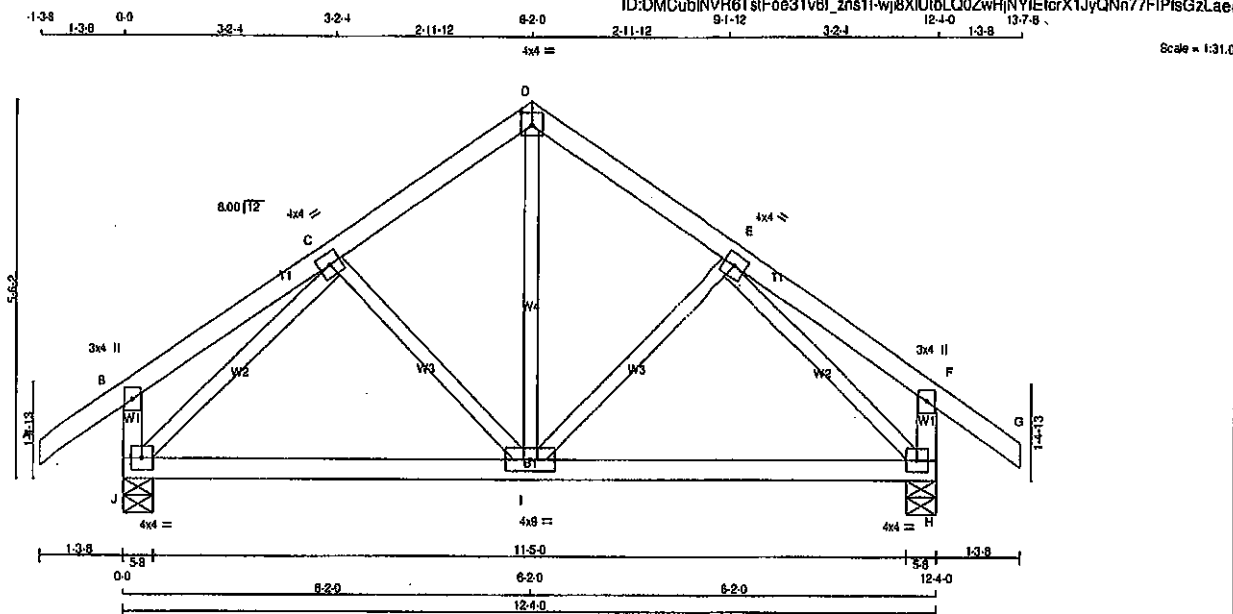

Scale = 1:31.0

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DESCR.
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMV+p	MT20	3.0	4.0	
C TMWW-I	MT20	4.0	4.0	
D TTW-p	MT20	4.0	4.0	2.25 2.00
E TMWW-I	MT20	4.0	4.0	
F TMV+p	MT20	3.0	4.0	
H BMVW1-I	MT20	4.0	4.0	
I BMVW1-I	MT20	4.0	9.0	
J BMVW1-I	MT20	4.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
J	806	0	806	0	5-8
H	806	0	806	0	5-8

UNFACTORED REACTIONS

JT	1ST LOOSE	MAX. MIN. COMPONENT REACTIONS	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	568	388/0	0/0	0/0	0/0	182.0	0/0
H	568	388/0	0/0	0/0	0/0	182.0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (LBS)	MAX. FACTORED (PLF)	MAX. FACTORED (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED (LBS)
FR-TO					FR-TO		
A-B	0/35	-91.8	-91.8	10.00	I-D	0/337	0.08 (1)
B-C	0/17	-91.8	-91.8	10.00	I-E	-139/0	0.04 (1)
C-D	-521/0	-91.8	-91.8	8.25	C-I	-139/0	0.04 (1)
D-E	-521/0	-91.8	-91.8	8.25	J-C	-737/0	0.23 (1)
E-F	0/17	-91.8	-91.8	10.00	E-H	-737/0	0.23 (1)
F-G	0/35	-91.8	-91.8	10.00			
J-B	-236/0	0.0	0.0	0.02 (1)			
H-F	-236/0	0.0	0.0	0.02 (1)			
J-I	0/517	-18.5	-18.5	0.24 (4)			
I-H	0/517	-18.5	-18.5	0.24 (4)			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.41")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.41")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.04")

CSI: TC=0.13/1.00 (B-C:1), BC=0.24/1.00 (H-I:4),
WB=0.23/1.00 (C-J:1), SS=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 610 354 1687 788 1997 1655

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.55 (E) (INPUT = 0.80)
JSI METAL = 0.25 (E) (INPUT = 1.00)



Structural component only
DWG# T-2008020

JOB NAME 408315	TRUSS NAME G16	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:16 2020 Page 1
ID:DMCubINVR0TstF0e31vG1_zns11-znWxzR3IH7EOXoG75oBOMOHpiXyPqzghblZLaF

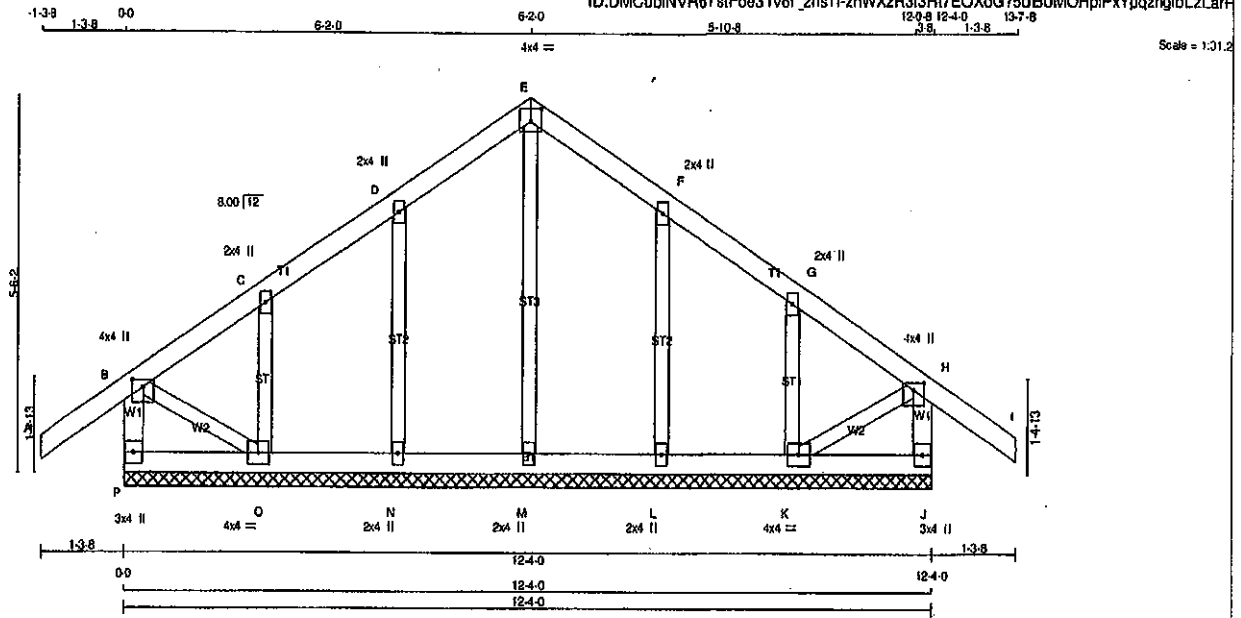

TOTAL WEIGHT = 54 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
P - B	2x4	DRY	No.2
A - E	2x4	DRY	No.2
E - I	2x4	DRY	No.2
J - H	2x4	DRY	No.2
P - J	2x4	DRY	No.2

ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (Table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMW+p	MT20	4.0	4.0	1.25	2.00
C, D, F, G					
C TMW+w	MT20	2.0	4.0		
E TTW+p	MT20	4.0	4.0	2.25	2.00
H TMW+p	MT20	4.0	4.0	1.25	2.00
J BMW1+p	MT20	3.0	4.0		
K BMW1+1	MT20	4.0	4.0		
L, M, N					
L BMW1+w	MT20	2.0	4.0		
O BMW1+1	MT20	4.0	4.0		
P BMW1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
P-B	-232 / 0	0.0	0.0 0.02 (1)	7.81	M-E	-137 / 0	0.08 (1)
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	N-D	-202 / 0	0.05 (1)
B-C	-19 / 0	-91.8	-91.8 0.05 (1)	6.25	O-C	-202 / 0	0.03 (1)
C-D	-22 / 0	-91.8	-91.8 0.05 (1)	6.25	L-F	-202 / 0	0.06 (1)
D-E	-27 / 0	-91.8	-91.8 0.05 (1)	6.25	K-G	-202 / 0	0.03 (1)
E-F	-27 / 0	-91.8	-91.8 0.05 (1)	6.25	B-O	0 / 28	0.01 (1)
F-G	-22 / 0	-91.8	-91.8 0.05 (1)	6.25	K-H	0 / 28	0.01 (1)
G-H	-19 / 0	-91.8	-91.8 0.05 (1)	6.25			
H-I	0 / 35	-91.8	-91.8 0.12 (1)	10.00			
J-H	-232 / 0	0.0	0.0 0.02 (1)	7.81			
P-O	0 / 0	-18.5	-18.5 0.02 (4)	10.00			
O-N	0 / 18	-18.5	-18.5 0.02 (4)	10.00			
N-M	0 / 14	-18.5	-18.5 0.02 (4)	10.00			
M-L	0 / 14	-18.5	-18.5 0.02 (4)	10.00			
L-K	0 / 18	-18.5	-18.5 0.02 (4)	10.00			
K-J	0 / 0	-18.5	-18.5 0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2016

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (H:I), BC=0.02/1.00 (K-L:4), WB=0.08/1.00 (E-M:1), SSI=0.08/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP/DRY SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1087 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.16 (B) (INPUT = 0.90)
JSI METAL= 0.10 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007994

JOB NAME 408315	TRUSS NAME T17	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	ORWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

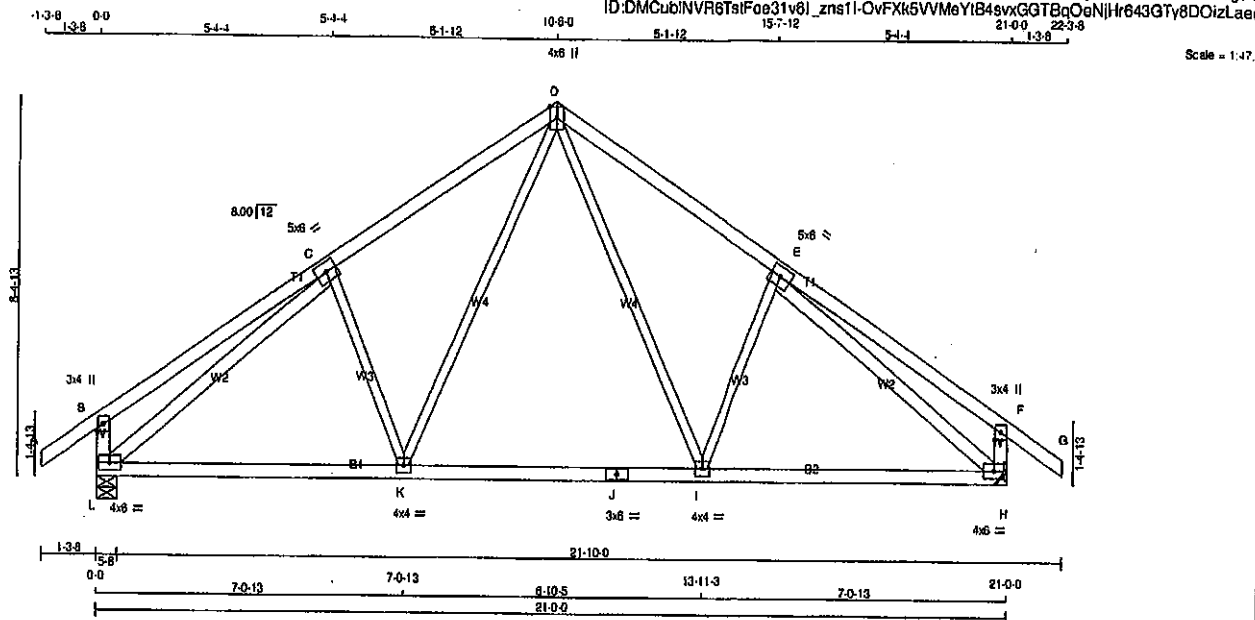

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
L - C	2x4	DRY	No.2
E - H	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (Table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-1	MT20	5.0	8.0		
D	TTWW+p	MT20	4.0	8.0	Edge	
E	TMWW-1	MT20	5.0	8.0		
F	TMV+p	MT20	3.0	4.0		
H	BMVW-1	MT20	4.0	8.0		
I	BMWW-1	MT20	4.0	4.0		
J	BS-1	MT20	3.0	8.0		
K	BMWW-1	MT20	4.0	4.0		
L	BMVW-1	MT20	4.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UP
L	1284	0	1284	0
H	1284	0	1284	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	905	608 / 0	0 / 0	0 / 0	0 / 0	298 / 0	0 / 0
H	905	608 / 0	0 / 0	0 / 0	0 / 0	298 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.52 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	MAX. CSI (LC)
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	D-I	0 / 475	10.00	0.11 (1)
B-C	0 / 32	-91.8	-91.8 0.42 (1)	E-F	-321 / 0	10.00	0.13 (1)
C-D	-1155 / 0	-91.8	-91.8 0.34 (1)	K-D	0 / 475	5.52	0.11 (1)
D-E	-1155 / 0	-91.8	-91.8 0.34 (1)	C-K	-321 / 0	5.52	0.13 (1)
E-F	0 / 32	-91.8	-91.8 0.42 (1)	L-C	-1403 / 0	10.00	0.89 (1)
F-G	0 / 35	-91.8	-91.8 0.12 (1)	E-H	-1403 / 0	10.00	0.89 (1)
L-B	-307 / 0	0.0	0.0 0.03 (1)				
H-F	-307 / 0	0.0	0.0 0.03 (1)				
L-K	0 / 1058	-18.5	-18.5 0.29 (4)				
K-J	0 / 749	-18.5	-18.5 0.27 (4)				
J-I	0 / 749	-18.5	-18.5 0.27 (4)				
I-H	0 / 1058	-18.5	-18.5 0.29 (4)				

TOTAL WEIGHT = 2 X 95 = 191 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.8	PSF
DL	= 6.0	PSF	
BOT CH.	LL	= 0.0	PSF
DL	= 7.4	PSF	
TOTAL LOAD	= 39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCG 2015, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TFC 2011, TFC 2014

(55% OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.70")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.04")
ALLOWABLE DEFL.(TL) = $L/360$ (0.70")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.09")

CSI: TC=0.42/1.00 (B-C:1), BC=0.29/1.00 (K-L:4), WB=0.89/1.00 (C-L:1), SSI=0.19/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	816	354	1887
	788	1987	1658


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.70 (E) (INPUT = 0.90)
JSI METAL= 0.38 (E) (INPUT = 1.00)



Structural component only
DWG# T-2008021

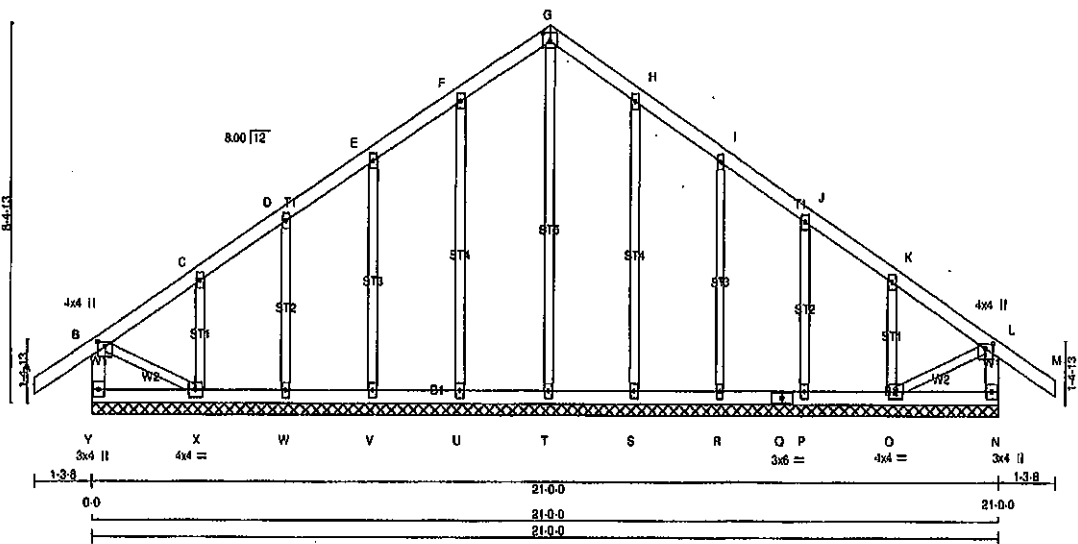

LUMBER N. L. G. A. RULES CHORDS SIZE Y - B 2x4 DRY No.2 A - G 2x4 DRY No.2 G - M 2x4 DRY No.2 N - L 2x4 DRY No.2 Y - Q 2x4 DRY No.2 Q - N 2x4 DRY No.2 ALL WEBS 2x3 DRY No.2 ALL GABLE WEBS 2x3 DRY No.2 DRY: SEASONED LUMBER. GABLE STUDS SPACED AT 2-0-0 OC.			DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 8.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. OC THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF BCBC 2018, OBC 2012, ABC 2019 - PART 9 OF OBC 2012 (2019 AMENDMENT) - CSA 086-09, CSA 086-14 - TPIC 2011, TPIC 2014 (55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD CSI: TC=0.12/1.00 (L-M:1), GC=0.03/1.00 (W-X:4), WB=0.18/1.00 (G-T:1), SS=0.09/1.00 (B-C:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 1.00 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1687 788 1987 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.59 (X) (INPUT = 0.90) JSI METAL= 0.12 (K) (INPUT = 1.00)			PLATES (table is in inches) JT TYPE PLATES W LEN Y X B TMVW+p MT20 4.0 4.0 1.25 2.00 C, D, E, F, H, I, J, K C TMVW+w MT20 2.0 4.0 G TTW+p MT20 4.0 4.0 2.25 2.00 L TMVW+p MT20 4.0 4.0 1.25 2.00 N BMV1+p MT20 3.0 4.0 O BMVW1-i MT20 4.0 4.0 P, R, S, T, U, V, W P BMW1+w MT20 2.0 4.0 Q BS-i MT20 3.0 6.0 X BMVW1-i MT20 4.0 4.0 Y BMV1+p MT20 3.0 4.0			BEARINGS THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS. THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE. BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD (PLF) MAX. CSI (LC) UNBRACED LENGTH WEBS MAX. FACTORED FORCE (LBS) MAX. CSI (LC) FR-TO Y-B -250 / 0 0.0 0.0 0.03 (1) 7.81 T-G -133 / 0 0.18 (1) A-B 0 / 35 -91.8 -91.8 0.12 (1) 10.00 U-F -208 / 0 0.18 (1) B-C -26 / 0 -91.8 -91.8 0.07 (1) 8.25 V-E -180 / 0 0.09 (1) C-D -38 / 0 -91.8 -91.8 0.07 (1) 8.25 W-D -167 / 0 0.05 (1) D-E -24 / 0 -91.8 -91.8 0.04 (1) 6.25 X-C -231 / 0 0.04 (1) E-F -20 / 0 -91.8 -91.8 0.05 (1) 6.25 S-H -208 / 0 0.18 (1) F-G -29 / 0 -91.8 -91.8 0.05 (1) 8.25 R-I -180 / 0 0.09 (1) G-H -28 / 0 -91.8 -91.8 0.05 (1) 6.25 P-J -187 / 0 0.05 (1) H-I -20 / 0 -91.8 -91.8 0.05 (1) 6.25 O-K -231 / 0 0.04 (1) I-J -24 / 0 -91.8 -91.8 0.04 (1) 6.25 B-X 0 / 34 0.01 (1) J-K -36 / 0 -91.8 -91.8 0.07 (1) 8.25 O-L 0 / 34 0.01 (1) K-L -26 / 0 -91.8 -91.8 0.07 (1) 8.25 L-M 0 / 35 -91.8 -91.8 0.12 (1) 10.00 N-L -250 / 0 0.0 0.0 0.03 (1) 7.81 Y-X 0 / 0 -18.5 -18.5 0.03 (4) 10.00 X-W 0 / 24 -18.5 -18.5 0.03 (4) 10.00 W-V 0 / 21 -18.5 -18.5 0.02 (4) 10.00 V-U 0 / 18 -18.5 -18.5 0.02 (4) 10.00 U-T 0 / 16 -18.5 -18.5 0.02 (4) 10.00 T-S 0 / 16 -18.5 -18.5 0.02 (4) 10.00 S-R 0 / 18 -18.5 -18.5 0.02 (4) 10.00 R-Q 0 / 21 -18.5 -18.5 0.02 (4) 10.00 Q-P 0 / 21 -18.5 -18.5 0.02 (4) 10.00 P-O 0 / 24 -18.5 -18.5 0.03 (4) 10.00 O-N 0 / 0 -18.5 -18.5 0.03 (4) 10.00		
---	--	--	--	--	--	--	--	--	--	--	--




JOB NAME 408315	TRUSS NAME T18	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 2019 MTEK Industries, Inc. Thu Apr 30 09:31:55 2020 Page 1

ID:DMCubINVR8TstFoe31v6L_zns11-KINH9nXmuGobQO7H3hltHFT2sXySa6xZxGdKsbzLaoc

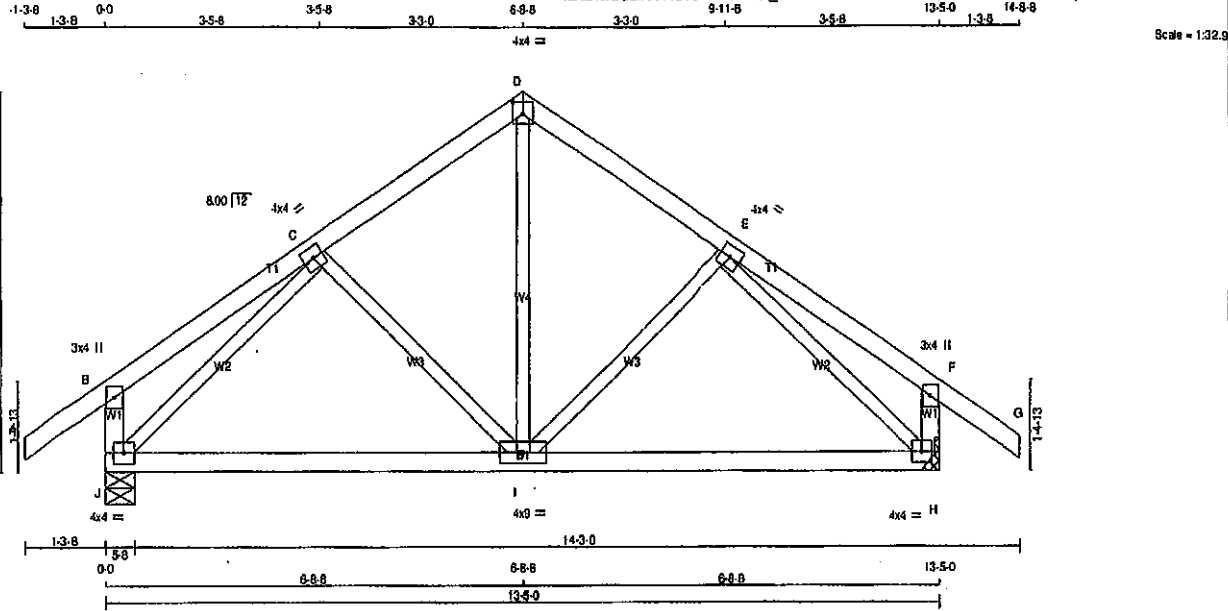

TOTAL WEIGHT = 3 X 58 = 175 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
J - B	2x4	DRY	No.2	SPF	
J - F	2x4	DRY	No.2	SPF	
H - H	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWV-1	MT20	4.0	4.0		
D	TTW-p	MT20	4.0	4.0	2.25	2.00
E	TMWV-1	MT20	4.0	4.0		
F	TMV+p	MT20	3.0	4.0		
H	BMWV1-1	MT20	4.0	4.0		
I	BMWVW-1	MT20	4.0	9.0		
J	BMWV1-1	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
J	888	0	888	0
H	888	0	888	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	810	413 / 0	0 / 0	0 / 0	0 / 0	196 / 0	0 / 0
H	810	413 / 0	0 / 0	0 / 0	0 / 0	196 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	I-D	0 / 379	0.08 (1)
B-C	0 / 19	-91.8	-91.8 0.16 (1)	10.00	I-E	-161 / 0	0.08 (1)
C-D	-577 / 0	-91.8	-91.8 0.12 (1)	6.25	C-I	-161 / 0	0.08 (1)
D-E	-577 / 0	-91.8	-91.8 0.12 (1)	6.25	J-C	-815 / 0	0.29 (1)
E-F	0 / 19	-91.8	-91.8 0.16 (1)	10.00	E-H	-815 / 0	0.29 (1)
F-G	0 / 35	-91.8	-91.8 0.12 (1)	10.00			
J-B	-245 / 0	0.0	0.0 0.03 (1)	7.81			
H-F	-245 / 0	0.0	0.0 0.03 (1)	7.81			
J-I	0 / 579	-18.5	-18.5 0.28 (4)	10.00			
I-H	0 / 579	-18.5	-18.5 0.28 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 91.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.45")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.45")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.05")

CSI: TC=0.16/1.00 (B-C:1), BC=0.28/1.00 (H-I:4), WB=0.29/1.00 (C-J:1), SI=0.12/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PLI)	SECTION (PLI)
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1587 788 1987 1556	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.71 (E) (INPUT = 0.80)
JSI METAL = 0.29 (C) (INPUT = 1.00)



Structural component only
DWG# T-2008022

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ORWG NO.
408315	G18	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 8 Oct 29 2019 MTek Industries, Inc. Thu Apr 30 09:31:19 2020 Page 1
ID:DMCubINVR6TstFos31v6I_zns11-NMCgcT5AMCFI6rFny7IVpf_vW0kz8INGfvQCgzLatM

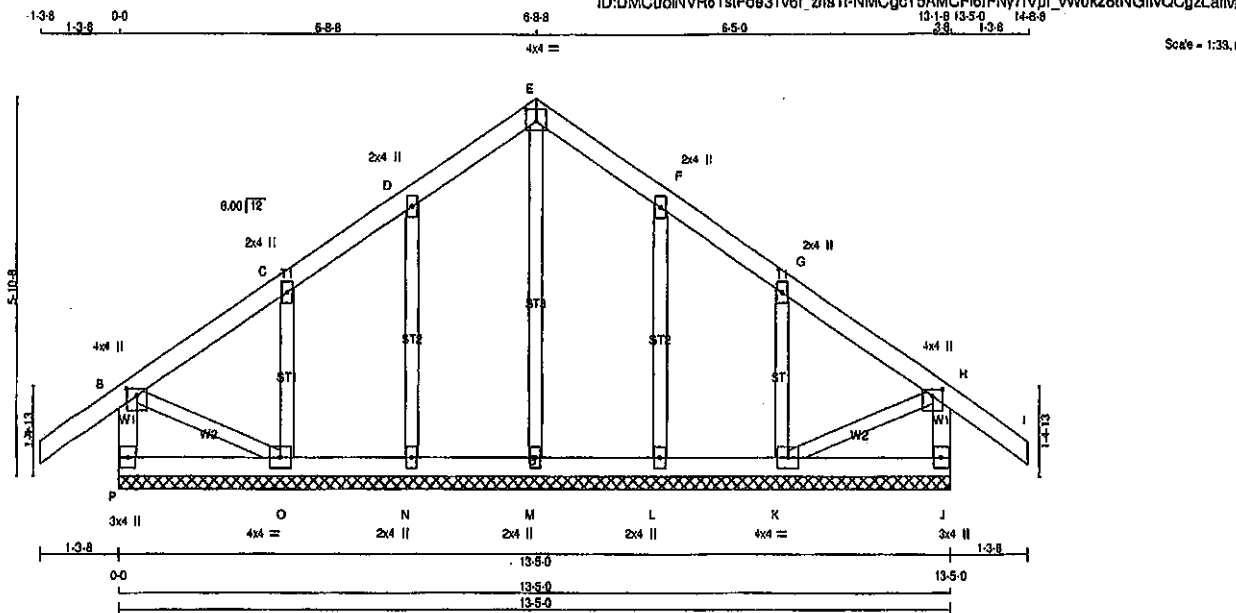

TOTAL WEIGHT = 59 lb (M)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
P - B	2x4	DRY	No.2	SPF		
A - E	2x4	DRY	No.2	SPF		
E - I	2x4	DRY	No.2	SPF		
J - H	2x4	DRY	No.2	SPF		
P - J	2x4	DRY	No.2	SPF		

ALL WEBS	2x3	DRY	No.2	SPF		
ALL GABLE WEBS	2x3	DRY	No.2	SPF		
DRY: SEASONED LUMBER.						

GABLE STUDS SPACED AT 2-0-0 OC.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO			
P-B	-252 / 0	0.0	0.0	0.03 (1)	M-E	-138 / 0	0.07 (1)
A-B	0 / 35	-91.8	-91.8	0.12 (1)	N-D	-189 / 0	0.08 (1)
E-B	-19 / 0	-91.8	-91.8	0.08 (1)	O-O	-241 / 0	0.05 (1)
C-D	-28 / 0	-91.8	-91.8	0.08 (1)	L-F	-189 / 0	0.08 (1)
D-E	-27 / 0	-91.8	-91.8	0.05 (1)	K-G	-241 / 0	0.05 (1)
E-F	-27 / 0	-91.8	-91.8	0.05 (1)	B-O	0 / 28	0.01 (1)
F-G	-29 / 0	-91.8	-91.8	0.08 (1)	K-H	0 / 28	0.01 (1)
G-H	-19 / 0	-91.8	-91.8	0.08 (1)			
H-I	0 / 35	-91.8	-91.8	0.12 (1)			
J-H	-252 / 0	0.0	0.0	0.03 (1)			
P-O	0 / 0	-18.5	-18.5	0.03 (4)			
O-N	0 / 19	-18.5	-18.5	0.03 (4)			
N-M	0 / 15	-18.5	-18.5	0.02 (4)			
M-L	0 / 15	-18.5	-18.5	0.02 (4)			
L-K	0 / 19	-18.5	-18.5	0.03 (4)			
K-J	0 / 0	-18.5	-18.5	0.03 (4)			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TO=0.12/1.00 (H-I), BC=0.03/1.00 (N-O), WB=0.07/1.00 (E-M), SSI=0.09/1.00 (B-C)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.18 (H) (INPUT = 0.90)
JSI METAL= 0.12 (G) (INPUT = 1.00)



Structural component only
DWG# T-2007996

JOB NAME 408316	TRUSS NAME T18S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 5 Oct 20 2019 MITek Industries, Inc. Thu Apr 30 10:05:21 2020 Page 1
ID:DMCubINVR6TslFoe31v6l_zns1l-bDbdAio2TcXz4fMqZ_lMaGYr69cWbOmQDMZUIJzLa9S

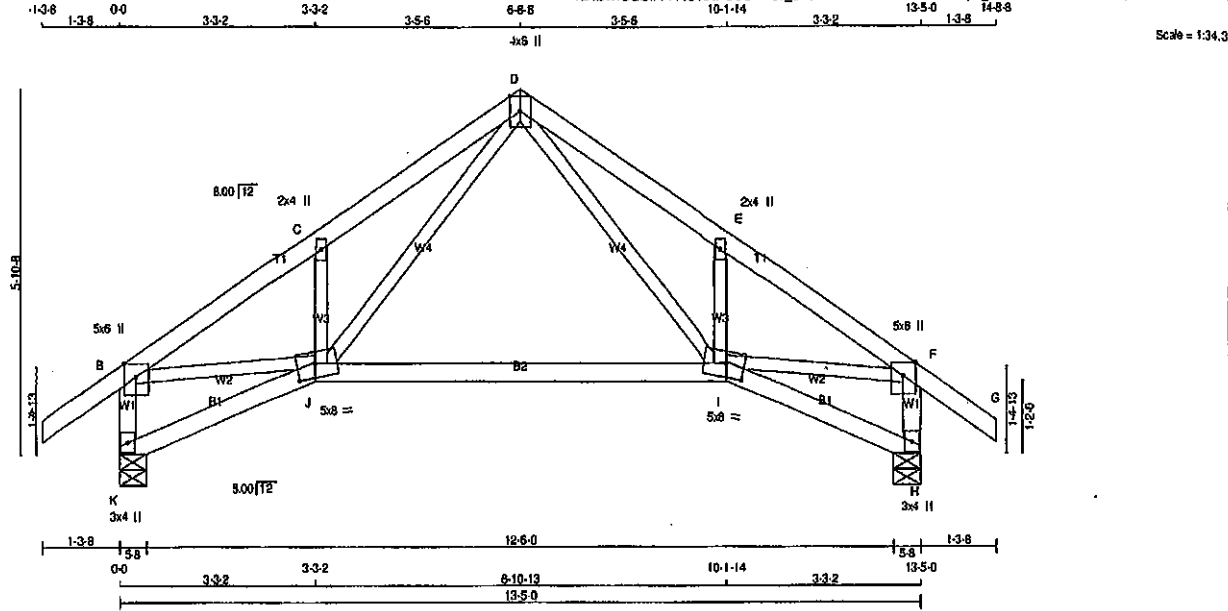

TOTAL WEIGHT = 2 X 57 = 115 lb (M/F)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - G	2x4	DRY	No.2	SPF		
K - B	2x4	DRY	No.2	SPF		
H - F	2x4	DRY	No.2	SPF		
K - J	2x4	DRY	No.2	SPF		
J - I	2x4	DRY	No.2	SPF		
I - H	2x4	DRY	No.2	SPF		
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMW+p	MT20	5.0	6.0	Edge	
C	TMW+w	MT20	2.0	4.0		
D	TTW+w	MT20	4.0	6.0	Edge	
E	TMW+w	MT20	2.0	4.0		
F	TMW+p	MT20	5.0	6.0	Edge	
H	BMV1+p	MT20	3.0	4.0		
I	BBWW-m	MT20	5.0	6.0	2.75	3.50
J	BBWW-m	MT20	5.0	6.0	2.75	3.50
K	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED				MAXIMUM FACTORED			
GROSS REACTION				GROSS REACTION			
JT	VERT	HORZ	DOWN	BRG	IN-SX	BRG	IN-SX
K	888	0	888	0	0	5-8	5-8
H	888	0	888	0	0	5-8	5-8
UNFACTORED REACTIONS							
1ST LOASE MAX. MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	610	413 / 0	0 / 0	0 / 0	0 / 0	198 / 0	0 / 0
H	610	413 / 0	0 / 0	0 / 0	0 / 0	198 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.84 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8 -91.8	0.12 (1)	10.00	D-I	0 / 523 0.14 (1)	
B-C	-1092 / 0	-91.8 -91.8	0.12 (1)	5.93	I-E	-389 / 0 0.08 (1)	
C-D	-1130 / 0	-91.8 -91.8	0.13 (1)	5.84	J-D	0 / 523 0.14 (1)	
D-E	-1130 / 0	-91.8 -91.8	0.13 (1)	5.84	J-C	-389 / 0 0.08 (1)	
E-F	-1092 / 0	-91.8 -91.8	0.12 (1)	5.93	B-J	0 / 523 0.21 (1)	
F-G	0 / 35	-91.8 -91.8	0.12 (1)	10.00	I-F	0 / 523 0.21 (1)	
K-B	-835 / 0	0.0 0.0	0.09 (1)	7.81			
H-F	-835 / 0	0.0 0.0	0.09 (1)	7.81			
K-J	0 / 0	-18.5 -18.5	0.08 (4)	10.00			
J-I	0 / 541	-18.5 -18.5	0.30 (4)	10.00			
I-H	0 / 0	-18.5 -18.5	0.08 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.45")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.45")
CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.13/1.00 (C-D:1), BC=0.30/1.00 (I-J:4), WB=0.21/1.00 (F:1:1), SSI=0.12/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1056

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.78 (F) (INPUT = 0.90)
JSI METAL= 0.48 (F) (INPUT = 1.00)



Structural component only
DWG# T-2008027

Tamarack Roof Truss, Burlington



JSI GRIP= 0.82 (J) (INPUT = 0.90)
JSI METAL= 0.34 (E) (INPUT = 1.00)




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408315	T20S	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 09:31:57 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns11-GgV1aTY0Pi2Jh9gA6LPMgYLeKe720asOa6QXTzLaem

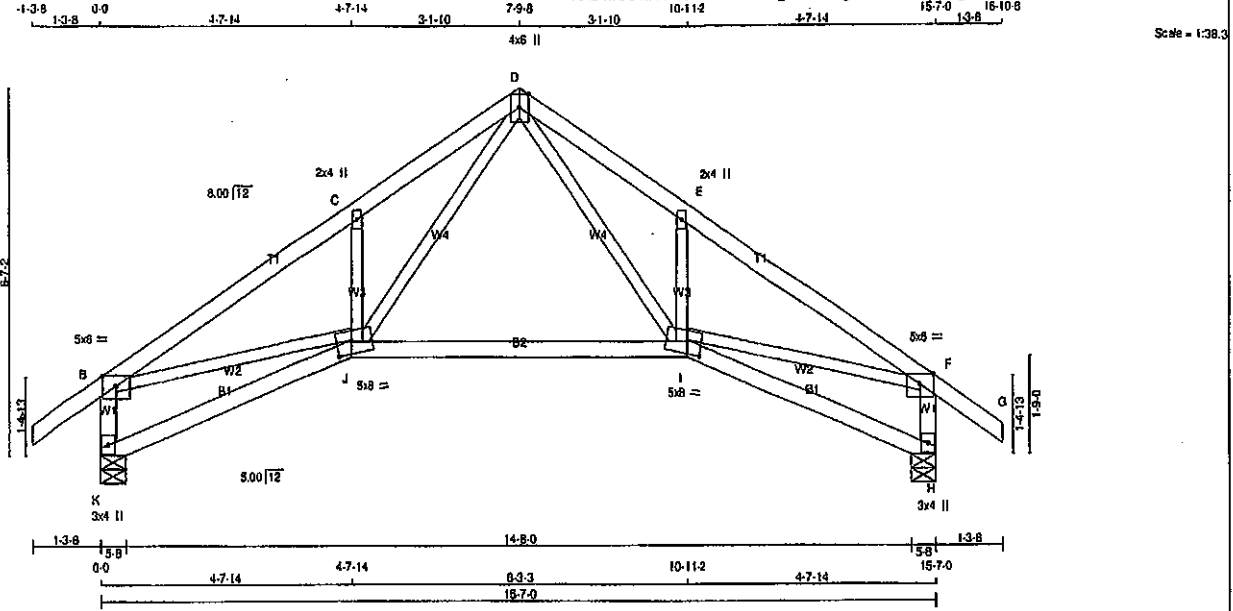

TOTAL WEIGHT = 2 X 66 = 132 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
K - B	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
K - J	2x4	DRY	No.2	SPF	
J - I	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
DRY: SEASONED LUMBER.					

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
	FACTORED	MAXIMUM FACTORED	INPUT	REQD					
	GROSS REACTION	GROSS REACTION	BRG	BRG					
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
K	985	0	985	0	0	5-8	5-8		
H	985	0	985	0	0	5-8	5-8		
UNFACTORED REACTIONS									
1ST CASE	MAX./MIN. COMPONENT REACTIONS								
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
K	694	489 / 0	0 / 0	0 / 0	0 / 0	225 / 0	0 / 0		
H	694	489 / 0	0 / 0	0 / 0	0 / 0	225 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.18 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED	VERT. LOAD	LC1	MAX.	MEMB.	MAX. FACTORED	VERT. LOAD	LC1	MAX.
	FORCE					FORCE			
	(LBS)					(LBS)			
FR-TO		FROM	TO	LENGTH	FR-TO		FROM	TO	LENGTH
A-B	0 / 35	-81.6	-81.6	0.12 (1)	10.00	D-I	0 / 880	0.20 (1)	
B-C	-1445 / 0	-81.6	-81.6	0.27 (1)	5.18	I-E	-445 / 0	0.08 (1)	
C-D	-1497 / 0	-81.6	-81.6	0.19 (1)	5.18	J-D	0 / 880	0.20 (1)	
D-E	-1497 / 0	-81.6	-81.6	0.19 (1)	5.18	B-J	-445 / 0	0.08 (1)	
E-F	-1445 / 0	-81.6	-81.6	0.27 (1)	5.18	H-J	0 / 1231	0.28 (1)	
F-G	0 / 35	-81.6	-81.6	0.12 (1)	10.00	I-F	0 / 1231	0.28 (1)	
K-B	-942 / 0	0.0	0.0	0.10 (1)	7.81				
H-F	-942 / 0	0.0	0.0	0.10 (1)	7.81				
K-J	0 / 0	-18.5	-18.5	0.12 (4)	10.00				
J-I	0 / 721	-18.5	-18.5	0.27 (4)	10.00				
I-H	0 / 0	-18.5	-18.5	0.12 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
ROT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.52")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.52")
CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CSI: TC=0.27/1.00 (B-C:1), BC=0.27/1.00 (I-J:4), WB=0.28/1.00 (F-I:1), SI=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.68 (F) (INPUT = 0.90)
JSI METAL = 0.30 (I) (INPUT = 1.00)




Structural component only
DWG# T-2008024

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T20S1	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:05:22 2020 Page 1
ID:DMCubINVR6TstF0e31v8l_zns1l-3P8002pgEvgIpx07hpb6LUS7cZylKqHzR011PmZLa9R

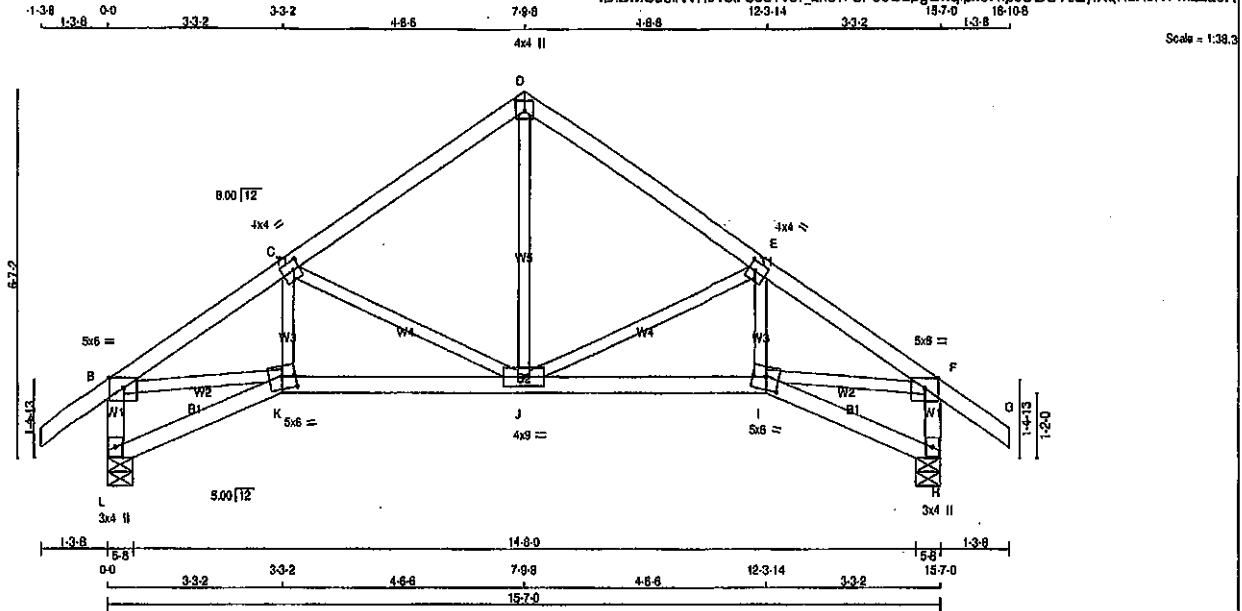

TOTAL WEIGHT = 2 X 68 = 132 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER			

PLATES (Table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0	8.0 Edge
C	TMWW-l	MT20	4.0	4.0 2.00 1.50
D	TTW-p	MT20	4.0	4.0 2.25 2.00
E	TMWW-l	MT20	4.0	4.0 2.00 1.50
F	TMVW-p	MT20	5.0	8.0 Edge
H	BMV1-p	MT20	3.0	4.0
I	BBWW-m	MT20	5.0	8.0 2.75 3.00
J	BMWW-l	MT20	4.0	9.0
K	BBWW-m	MT20	5.0	8.0 2.75 3.00
L	BMV1-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG
L	985	0	985	0	0	5-8	5-8	5-8	5-8
H	985	0	985	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS							
1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	694	469 / 0	0 / 0	0 / 0	0 / 0	225 / 0	0 / 0
H	694	469 / 0	0 / 0	0 / 0	0 / 0	225 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.41 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	MEMB.
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	J-D	0 / 551	0.12 (1)
B-C	-1334 / 0	-91.8	-91.8 0.19 (1)	5.41	J-E	-516 / 0	0.21 (1)
C-D	-818 / 0	-91.8	-91.8 0.21 (1)	6.25	I-E	0 / 98	0.03 (4)
D-E	-818 / 0	-91.8	-91.8 0.21 (1)	6.25	C-J	-516 / 0	0.21 (1)
E-F	-1334 / 0	-91.8	-91.8 0.19 (1)	5.41	K-C	0 / 98	0.03 (4)
F-G	0 / 35	-91.8	-91.8 0.12 (1)	10.00	B-K	0 / 1132	0.25 (1)
L-B	-955 / 0	0.0	0.0 0.10 (1)	7.81	I-F	0 / 1132	0.25 (1)
H-F	-955 / 0	0.0	0.0 0.10 (1)	7.81			
L-K	0 / 0	-18.5	-18.5 0.08 (4)	10.00			
K-J	0 / 1127	-18.5	-18.5 0.24 (1)	10.00			
J-I	0 / 1127	-18.5	-18.5 0.24 (1)	10.00			
I-H	0 / 0	-18.5	-18.5 0.08 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.52")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.52")
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CSI: TC=0.21/1.00 (D-E:1), BC=0.24/1.00 (J-K:1),
WB=0.25/1.00 (B-K:1), SS=0.18/1.00 (D-E:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE REELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.74 (D) (INPUT = 0.90)
JSI METAL= 0.27 (I) (INPUT = 1.00)



Structural component only
DWG# T-2008028


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	T21	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Thu Apr 30 09:31:59 2020 Page 1

ID:DMCubiNVR6TslFoe31v8l_zns1l-D3do78aGxU1v7J3lXNIR5ea78DeWnG9stbXbMzLaek

0-0 3-8 7-12 14-12 14-11-0 14-12 14-7-9 14-11-0 2-12-3-8

Scale = 1:20.0

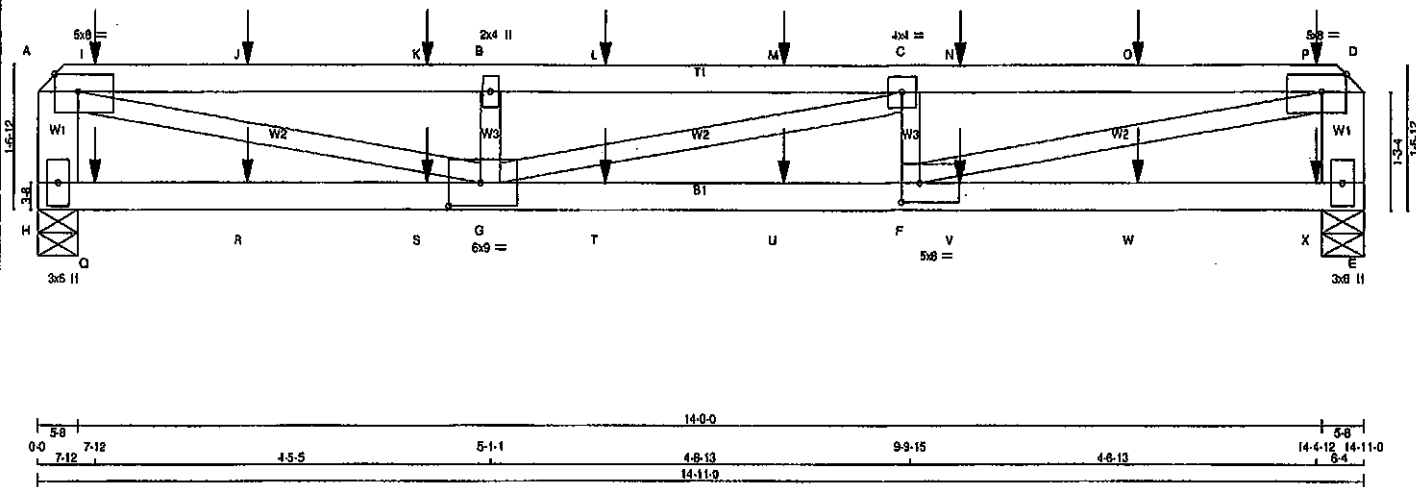

TOTAL WEIGHT = 50 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No. 2	SPF	
H - A	2x6	DRY	No. 2	SPF	
E - D	2x8	DRY	No. 2	SPF	
H - E	2x4	DRY	No. 2	SPF	
ALL WEBS	2x3	DRY	No. 2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMW-1	MT20	5.0	8.0	Edge	3.25
B	TMW-w	MT20	2.0	4.0		
C	TMW-1	MT20	4.0	4.0		
D	TMW-1	MT20	5.0	8.0	Edge	3.25
E	BMV1+p	MT20	3.0	6.0		
F	BMW-1	MT20	5.0	8.0	2.50	2.50
G	BMW-1	MT20	6.0	9.0	3.00	4.25
H	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORIZ	BRG	BRG	IN-SX	IN-SX
H	1220	0	1220	0	0	5-8	5-8		
E	1224	0	1224	0	0	5-8	5-8		

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	883	588 / 0	0 / 0	0 / 0	0 / 0	297 / 0	0 / 0
E	865	588 / 0	0 / 0	0 / 0	0 / 0	297 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.08 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (PLF)	MAX. (LBS)	MEMB.	FORCE (LBS)	MAX. (LBS)
FR-TO		FROM	TO	LENGTH	FR-TO		
A-I	-3288 / 0	-91.8	-91.8	0.73 (1)	F-D	0 / 3390	0.84 (1)
I-J	-3288 / 0	-91.8	-91.8	0.73 (1)	A-G	0 / 3397	0.84 (1)
J-K	-3288 / 0	-91.8	-91.8	0.73 (1)	F-C	-830 / 0	0.10 (1)
K-B	-3288 / 0	-91.8	-91.8	0.73 (1)	G-B	-832 / 0	0.10 (1)
B-L	-3288 / 0	-91.8	-91.8	0.55 (1)	G-C	0 / 7	0.00 (1)
L-M	-3288 / 0	-91.8	-91.8	0.55 (1)			
M-C	-3288 / 0	-91.8	-91.8	0.55 (1)			
C-N	-3288 / 0	-91.8	-91.8	0.71 (1)			
N-O	-3288 / 0	-91.8	-91.8	0.71 (1)			
O-P	-3288 / 0	-91.8	-91.8	0.71 (1)			
P-D	-3288 / 0	-91.8	-91.8	0.71 (1)			
H-A	-1113 / 0	0.0	0.0	0.08 (1)			
E-D	-1116 / 0	0.0	0.0	0.08 (1)			
H-Q	0 / 0	-18.5	-18.5	0.19 (1)			
O-R	0 / 0	-18.5	-18.5	0.19 (1)			
R-S	0 / 0	-18.5	-18.5	0.19 (1)			
S-G	0 / 0	-18.5	-18.5	0.19 (1)			
G-T	0 / 3289	-18.5	-18.5	0.71 (1)			
T-U	0 / 3289	-18.5	-18.5	0.71 (1)			
U-F	0 / 3289	-18.5	-18.5	0.71 (1)			
F-V	0 / 0	-18.5	-18.5	0.19 (1)			
V-W	0 / 0	-18.5	-18.5	0.19 (1)			
W-X	0 / 0	-18.5	-18.5	0.19 (1)			
X-E	0 / 0	-18.5	-18.5	0.19 (1)			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LOC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
I	7-12	-71	-71	---	FRONT	VERT	TOTAL	---	C1
J	2-4-12	-54	-54	---	FRONT	VERT	TOTAL	---	C1
K	4-4-12	-54	-54	---	FRONT	VERT	TOTAL	---	C1
L	8-4-12	-54	-54	---	FRONT	VERT	TOTAL	---	C1
M	8-4-12	-54	-54	---	FRONT	VERT	TOTAL	---	C1
N	10-4-12	-54	-54	---	FRONT	VERT	TOTAL	---	C1
O	12-4-12	-54	-54	---	FRONT	VERT	TOTAL	---	C1
P	14-4-12	-78	-78	---	FRONT	VERT	TOTAL	---	C1
Q	7-12	-43	-43	---	FRONT	VERT	TOTAL	---	C1
R	2-4-12	-40	-40	---	FRONT	VERT	TOTAL	---	C1
S	4-4-12	-40	-40	---	FRONT	VERT	TOTAL	---	C1
T	8-4-12	-40	-40	---	FRONT	VERT	TOTAL	---	C1
U	8-4-12	-40	-40	---	FRONT	VERT	TOTAL	---	C1
V	10-4-12	-40	-40	---	FRONT	VERT	TOTAL	---	C1
W	12-4-12	-40	-40	---	FRONT	VERT	TOTAL	---	C1

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.50")
CALCULATED VERT. DEFL.(LL) = 1/882 (0.20")
ALLOWABLE DEFL.(TL) = L/360 (0.50")
CALCULATED VERT. DEFL.(TL) = 1/477 (0.38")

CSI: TC=0.73/1.00 (A-B:1), BC=0.71/1.00 (F-G:1),
WB=0.84/1.00 (A-G:1), SS=0.31/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (G) (INPUT = 0.80)
JSI METAL= 0.62 (A) (INPUT = 1.00)



Structural component only
DWG# T-2008025 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	T21	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 6.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:59 2020 Page 2

ID:DMCubINVR6TstFoe31v6I zns1I-D3dp78aGxUI1v7J3IXNIR5ea78DeWnG9stbXbMzLaek

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
X	14-4-12	-44	-44	...	FRONT	VERT	TOTAL	...	C1


CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2008025 7/2

JOB NAME 408316	TRUSS NAME T30	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:05:23 2020 Page 1	
ID:DMCubINVR8tstFos91v8l_zns1l-XbiObQj?DnhKzWChPKqfhe9rzD3Ac7gg2axCzLa9Q				23-2-6 3-10-11 27-1-3 28-11-8 31-7-8 33-0-4 35-1-0 38-4-8	
1-3-8 0-0 3-5-8 4-6-5 7-11-13 3-10-11 11-10-8 5-8-0 17-6-8 5-8-0 3-10-11 1-10-5 2-8-0 1-4-12 2-0-12 1-3-8				Scale = 1:50.2	

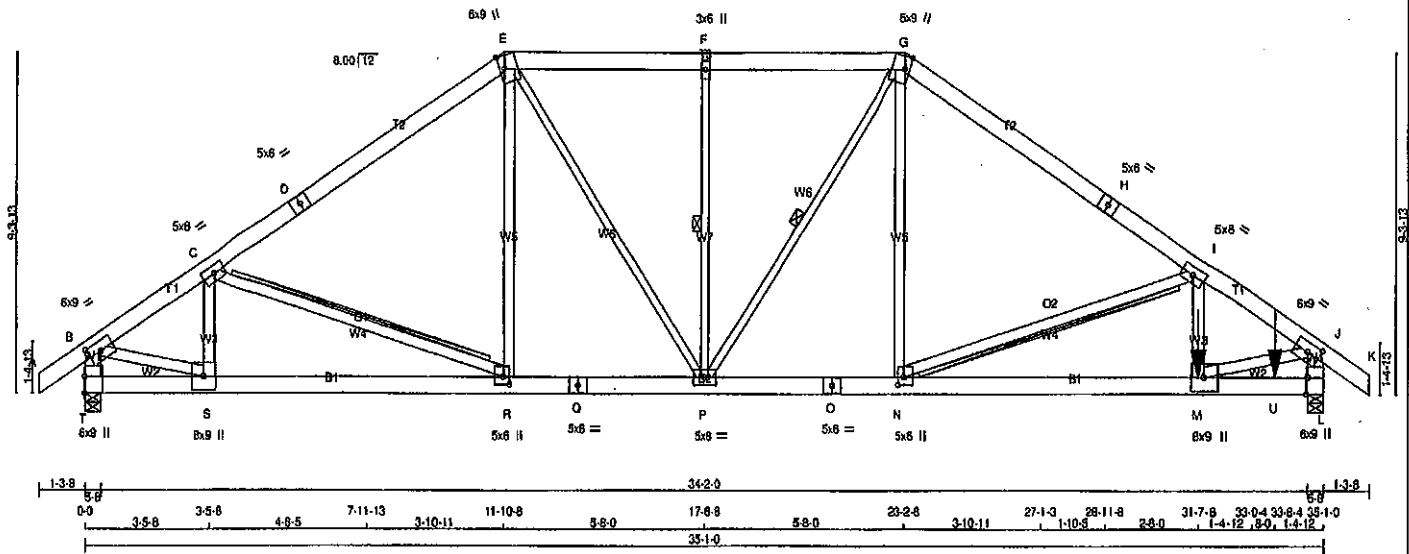

TOTAL WEIGHT = 2 X 219 = 437 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x6	DRY	No.2
D - E	2x6	DRY	No.2
E - G	2x6	DRY	No.2
G - H	2x6	DRY	No.2
H - K	2x6	DRY	No.2
T - B	2x6	DRY	No.2
L - J	2x6	DRY	No.2
T - Q	2x6	DRY	No.2
Q - O	2x6	DRY	No.2
O - L	2x6	DRY	No.2
ALL WEBS	2x4	DRY	No.2
EXCEPT			
P - G	2x3	DRY	No.2
E - P	2x3	DRY	No.2
P - F	2x3	DRY	No.2

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-D	2	12
D-E	2	12
E-G	2	12
G-H	2	12
H-K	2	12
T-B	2	12
L-J	2	12
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
T-Q	2	12
Q-O	2	12
O-L	2	12
WEBS: (0.122"x3") SPIRAL NAILS		
M-I	2	6
2x4	1	6
S-C	2	2

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT RECD
JT	VERT	DOWN	BRG
T	2840	0	5-8
L	7741	0	5-8

UNFACTORED REACTIONS			
	1ST LOASE	MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE
T	1884	1241	0
L	5484	3643	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.85 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-P, F-P.
2x4 DRY SPF No.2 T-BRACE AT C-R
2x8 DRY SPF No.2 T-BRACE AT I-N
FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING			
TOTAL LOAD CASES: (4)			
MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	WEBS MAX. FACTORED FORCE (LBS)
FR-TO			
A-B	0:36	-91.8	-91.8
B-C	-3133	0	-91.8
C-D	-3051	0	-91.8
D-E	-3051	0	-91.8
E-F	-3089	0	-91.8
F-G	-3089	0	-91.8
G-H	-3902	0	-91.8
H-I	-3902	0	-91.8
I-J	-9121	0	-91.8
J-K	0:36	-91.8	-91.8
T-B	-2810	0	-91.8
L-J	-7254	0	-91.8
T-S	0:0	-18.5	-18.5
S-R	0:2682	-18.5	-18.5
R-Q	0:2509	-18.5	-18.5
Q-P	0:2509	-18.5	-18.5
P-O	0:3253	-18.5	-18.5
O-N	0:3253	-18.5	-18.5
N-M	0:7839	-18.5	-18.5
M-U	0:0	-18.5	-18.5
U-L	0:0	-18.5	-18.5

FACTORED CONCENTRATED LOADS (LBS)			
JT	LOC.	LC1	MAX.
M	31-7-8	-5689	-5689
U	33-8-4	-684	-684

CONNECTION REQUIREMENTS			
JT	LOC.	LC1	MAX.
M	31-7-8	-5689	-5689
U	33-8-4	-684	-684

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CSI: TC=0.31/1.00 (G-I), BC=0.57/1.00 (M-N), W8=0.70/1.00 (J-M), SSI=0.18/1.00 (L-M)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PLI) (PLI)
MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (R) (INPUT = 0.90)
JSI METAL= 0.88 (R) (INPUT = 1.00)

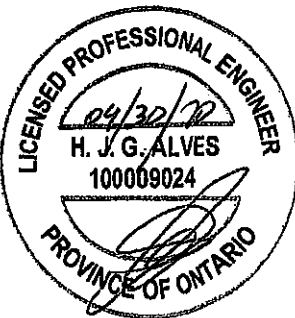

Structural component only
DWG# T-2008029 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T30	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 5 Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:05:23 2020 Page 2

ID:DMCubINVR6TstFoe31v6I zns1I-XbiObOqJ?DnhKzWChPKqhe9rzDi3Ac7gg2axCzLa8Q

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	6.0	9.0	3.00	4.25
C	TMVW-t	MT20	5.0	8.0		
D	TS-t	MT20	5.0	6.0		
E	TTWW+m	MT20	6.0	9.0	4.25	1.50
F	TMVW+m	MT20	3.0	6.0		
G	TTWW+m	MT20	6.0	9.0	4.25	1.50
H	TS-t	MT20	5.0	6.0		
I	TMVW-t	MT20	5.0	8.0		
J	TMVW-t	MT20	6.0	9.0	3.00	4.25
L	BMV-t	MT20	6.0	9.0	Edge	0.50
M	BMVW-t	MT20	8.0	9.0		
N	BMVW-t	MT20	5.0	8.0	2.50	2.00
O	BS-t	MT20	5.0	6.0		
P	BMVW-t	MT20	5.0	8.0		
Q	BS-t	MT20	5.0	6.0		
R	BMVW-t	MT20	5.0	8.0	2.50	2.00
S	BMVW-t	MT20	8.0	9.0		
T	BMV-t	MT20	8.0	9.0	5.50	


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2008029 7/2

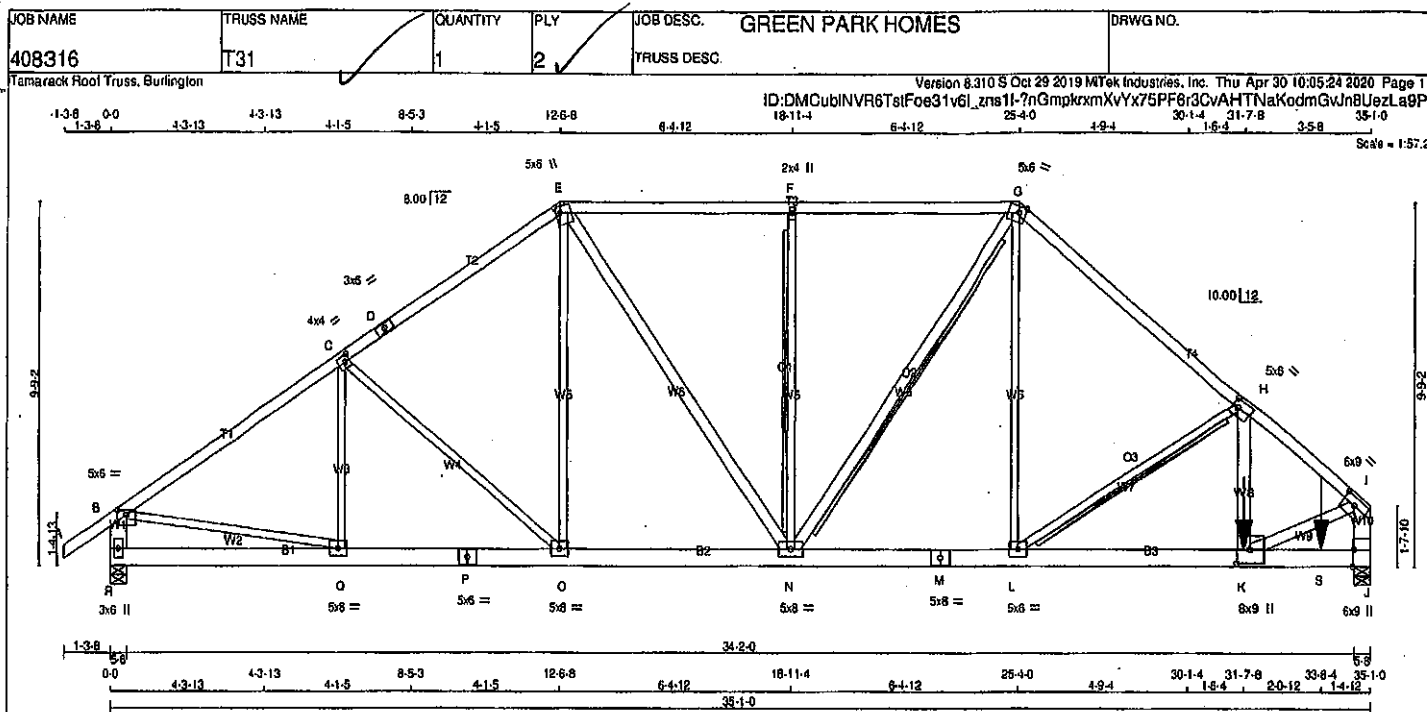

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - E	2x4	DRY	No.2	SPF		
E - G	2x4	DRY	No.2	SPF		
G - I	2x4	DRY	No.2	SPF		
R - B	2x6	DRY	No.2	SPF		
J - I	2x6	DRY	No.2	SPF		
R - P	2x8	DRY	No.2	SPF		
P - M	2x8	DRY	No.2	SPF		
M - J	2x6	DRY	No.2	SPF		
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF		
K - H	2x4	DRY	No.2	SPF		
K - I	2x4	DRY	No.2	SPF		
N - G	2x4	DRY	No.2	SPF		
E - N	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-D 1	12	TOP
D-E 1	12	TOP
E-G 1	12	TOP
G-I 1	12	TOP
R-B 2	12	TOP
J-I 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
R-P 2	12	TOP
P-M 2	12	TOP
M-J 2	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	SIDE(183.1)
H-K 2	3	SIDE(1410.3)
2x4 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	UPLIFT
R	2889	0	2889	0
J	8097	0	8097	0

UNFACTORED REACTIONS

1ST CASE	MAX/MIN. COMPONENT REACTIONS	DEAD	SOIL
JT	COMBINED	SNOW	LIVE
R	1899	1284	0
J	5718	3798	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.04 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x6 DRY SPF No.2 T-BRACE AT H-L, G-N
2x4 DRY SPF No.2 T-BRACE AT F-N

FASTEN T AND L-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO		
A-B	0/35	-91.8	0.07 (1)	Q-C	-321/0	0.08 (1)
B-C	-3291/0	-91.8	0.49 (1)	C-D	-345/0	0.24 (1)
C-D	-3058/0	-91.8	0.45 (1)	D-E	0/358	0.04 (1)
D-E	-3058/0	-91.8	0.45 (1)	E-F	0/2223	0.28 (1)
E-F	-3118/0	-91.8	0.44 (1)	F-G	-3808/0	0.70 (1)
F-G	-3118/0	-91.8	0.44 (1)	G-H	0/2801	0.35 (1)
G-H	-4126/0	-91.8	0.49 (1)	H-I	0/4142	0.37 (1)
H-I	-8211/0	-91.8	0.51 (1)	I-J	0/6730	0.59 (1)
R-B	-2628/0	0.0	0.09 (1)	J-K	-88/0	0.02 (1)
J-I	-7603/0	0.0	0.28 (1)	K-L	0/1075	0.10 (1)
R-Q	0/0	-18.5	-18.5 0.05 (4)	L-M	-711/0	0.34 (1)
Q-P	0/2769	-18.5	-18.5 0.20 (1)	M-N		
P-O	0/2769	-18.5	-18.5 0.20 (1)			
O-N	0/2512	-18.5	-18.5 0.19 (1)			
N-M	0/3167	-18.5	-18.5 0.24 (1)			
M-L	0/3167	-18.5	-18.5 0.24 (1)			
L-K	0/6348	-18.5	-18.5 0.48 (1)			
K-S	0/0	-18.5	-18.5 0.25 (1)			
S-J	0/0	-18.5	-18.5 0.25 (1)			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
K	31-7.8	-8108	-8108	---	FRONT	VERT	TOTAL	---	C1
S	33-8.4	-684	-684	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL	= 6.0	PSF
BOT CH.	LL = 0.0	PSF
DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = U/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = U/999 (0.14")

CSI: TC=0.51/1.00 (H-L), BC=0.48/1.00 (K-L), WB=0.70/1.00 (H-L), SS=0.18/1.00 (J-K)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
M20	618 354	1667 798
		1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.88 (E) (INPUT = 0.90)
JSI METAL=0.72 (K) (INPUT = 1.00)




Structural component only
DWG# T-2008030 1/2

CONTINUED ON PAGE 2

JOB NAME 408316	TRUSS NAME T32	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:05:25 2020 Page 1

ID:DMCubINVR6TstFoe31v61_zns11-T_q803sZXq1PZHgbqMk6jMpmxDX7wQ8zXh042La9C

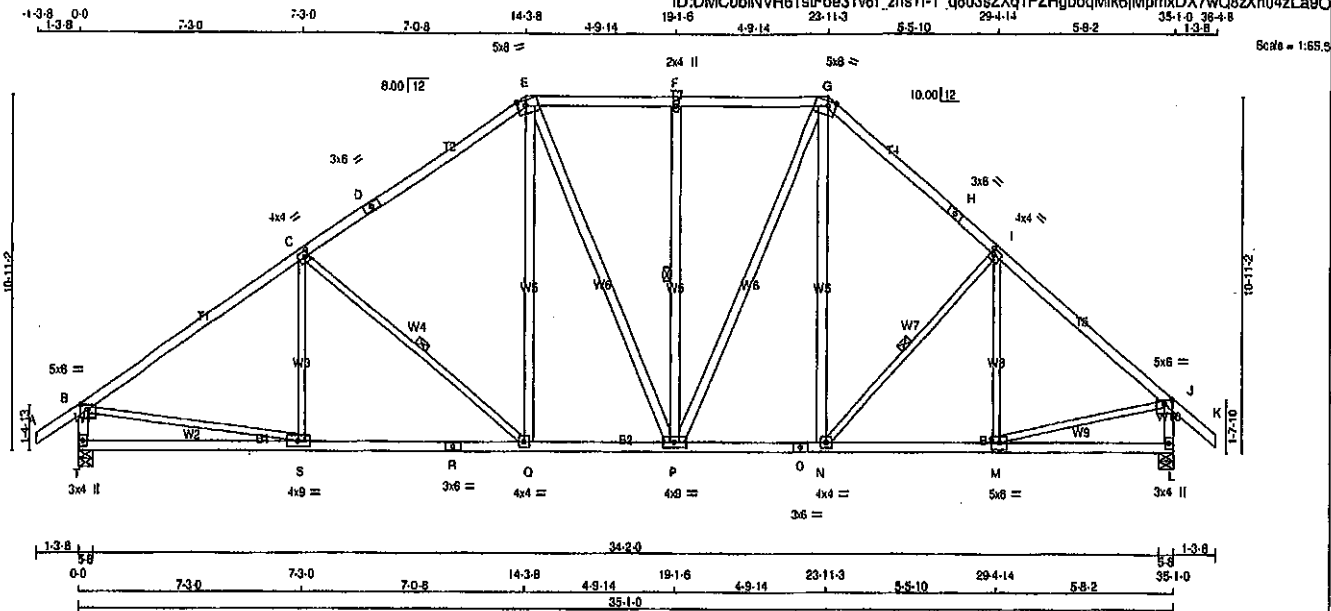

TOTAL WEIGHT = 188 lb (M/F)

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
T - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
T - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS	2x4	DRY	No.2
EXCEPT			
S - C	2x3	DRY	No.2
C - Q	2x3	DRY	No.2
N - I	2x3	DRY	No.2
M - I	2x3	DRY	No.2
B - S	2x3	DRY	No.2
M - J	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMWV-p	MT20	5.0	6.0	1.75	2.75
C TMWV-t	MT20	4.0	4.0	2.00	1.50
D TS-I	MT20	3.0	6.0		
E TTWV-m	MT20	5.0	8.0	2.00	3.00
F TMWV-w	MT20	2.0	4.0		
G TTWV-m	MT20	5.0	8.0	Edge	3.00
H TS-I	MT20	3.0	6.0		
I TMWV-t	MT20	4.0	4.0	2.00	1.25
J TMWV-p	MT20	6.0	6.0	1.50	3.00
L BMV1+p	MT20	3.0	4.0		
M BMWV-t	MT20	5.0	6.0		
N BMWV-t	MT20	4.0	4.0		
O BS-I	MT20	3.0	6.0		
P BMWV-t	MT20	4.0	4.0		
Q BMWV-t	MT20	4.0	4.0		
R BS-I	MT20	3.0	6.0		
S BMWV-t	MT20	4.0	4.0		
T BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED	MAXIMUM FACTORED	INPUT	REQD	
	GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	DOWN	HORIZ	UPLIFT	IN-SX
T	2060	0	0	5.8	5.8
L	2061	0	0	5.8	5.8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
T	1454	988/0	0/0	0/0	0/0	487/0	0/0
L	1455	988/0	0/0	0/0	0/0	487/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.53 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-Q, F-P, I-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/35	-91.8	-91.8 0.12 (1)	10.00	S-C	-146/72	0.09 (1)
B-C	-2352/0	-91.8	-91.8 0.65 (1)	3.53	C-Q	-585/0	0.35 (1)
C-D	-1899/0	-91.8	-91.8 0.75 (1)	3.96	Q-E	0/484	0.08 (1)
D-E	-1899/0	-91.8	-91.8 0.75 (1)	3.96	E-P	0/145	0.02 (1)
E-F	-1808/0	-91.8	-91.8 0.30 (1)	4.80	P-F	-538/0	0.33 (1)
F-G	-1608/0	-91.8	-91.8 0.30 (1)	4.90	P-G	0/526	0.08 (1)
G-H	-1848/0	-91.8	-91.8 0.45 (1)	4.49	N-G	0/318	0.05 (1)
H-I	-1848/0	-91.8	-91.8 0.45 (1)	4.49	N-I	-302/0	0.14 (1)
I-J	-2032/0	-91.8	-91.8 0.48 (1)	4.29	M-I	-250/9	0.18 (1)
J-K	0/41	-91.8	-91.8 0.13 (1)	10.00	G-S	0/2015	0.45 (1)
T-B	-2005/0	0.0	0.0 0.21 (1)	5.98	M-J	0/1633	0.37 (1)
L-J	-2017/0	0.0	0.0 0.21 (1)	5.94			
T-S	0/0	-18.5	-18.5 0.24 (4)	10.00			
S-R	0/1983	-18.5	-18.5 0.44 (1)	10.00			
R-Q	0/1983	-18.5	-18.5 0.44 (1)	10.00			
Q-P	0/1548	-18.5	-18.5 0.32 (1)	10.00			
P-O	0/1390	-18.5	-18.5 0.28 (1)	10.00			
O-N	0/1390	-18.5	-18.5 0.28 (1)	10.00			
N-M	0/1591	-18.5	-18.5 0.32 (1)	10.00			
M-L	0/0	-18.5	-18.5 0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL = 8.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.08')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.18')

CS1: TC=0.85/1.00 (B-C:1), BC=0.44/1.00 (O-S:1), WB=0.45/1.00 (B-S:1), SI=0.27/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1887 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (J) (INPUT = 0.90)
JSI METAL = 0.87 (R) (INPUT = 1.00)



Structural component only
DWG# T-2008031

Structural component only
DWG# T-2008032


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408316	T34	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 2019 Mitek Industries, Inc. Thu Apr 30 11:34:36 2020 Page 1

ID:DMCubINVR6TsiF0s31v6I_zns1H1QI24mc3MwC9tcE0m7s76XrxdoD6mB1b_EKJRzLYrn

1-3-8 3-0 5-4-4 5-4-4 5-1-12 10-6-0 5-6-5 16-0-5 5-5-1 21-5-5 5-6-5 26-11-10 3-11-7 30-11-131-7-8 3-5-8 35-1-0
Scale = 1/56.3

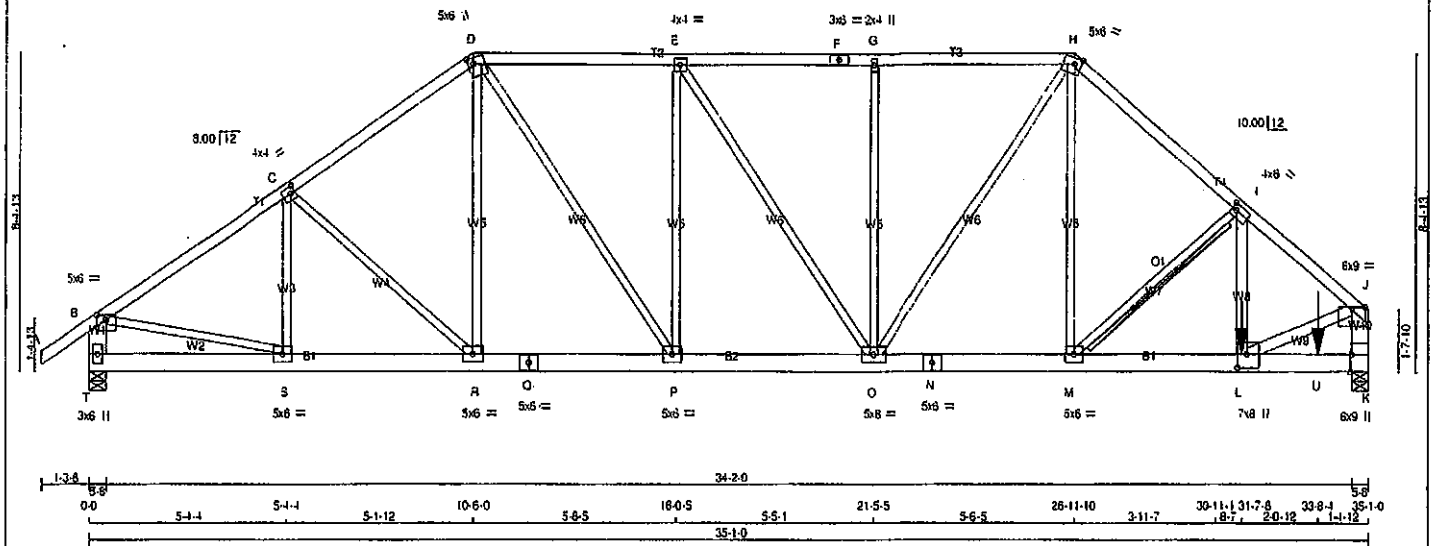

TOTAL WEIGHT = 2 X 187 = 374 lb (M)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
T - B	2x6	DRY	No.2	SPF	
K - J	2x6	DRY	No.2	SPF	
T - Q	2x6	DRY	No.2	SPF	
Q - N	2x6	DRY	No.2	SPF	
N - K	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
L - I	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS	#ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS			
A-D	1	12	TOP
D-F	1	12	TOP
F-H	1	12	TOP
H-J	1	12	TOP
T-B	2	12	TOP
K-J	2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS			
T-Q	2	12	TOP
Q-N	2	12	TOP
N-K	2	12	SIDE(183.11)
WEBS : (0.122"x3") SPIRAL NAILS			
2x3	1	6	SIDE(1194.0)
I-L	2	3	
2x4	1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		GROSS REACTION		GROSS REACTION		INPUT		RECORD	
JT	VERT	DOWN	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG	BRG	IN-SX
T	2603	0	0	2603	0	0	5-8	5-8	5-8	5-8	5-8
K	7230	0	0	7230	0	0	5-8	5-8	5-8	5-8	5-8
UNFACTORED REACTIONS		1ST LCASE		MAX. MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERMATIVE	WIND	DEAD	SOIL				
T	1837	1223	0	0-0	0-0	0-0	614	0	0	0	0
K	5106	3392	0	0-0	0-0	0-0	1714	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.42 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT I-M

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRAC	MEMB.	FORCE (LBS)	MAX. CS1 (LC)	MAX. CS1 (LC)	MAX. CS1 (LC)
FR-TO		FROM	TO	LENGTH	FR-TO				
A-B	0 35	-91.8	-91.8	0.07 (1)	10.00	S-C	-418	0	0.07 (1)
B-C	-3111	0	-91.8	-91.8	0.30 (1)	4.96	C-R	-180	0
C-D	-3032	0	-91.8	-91.8	0.30 (1)	5.01	R-D	0 231	0.03 (1)
D-E	-3217	0	-91.8	-91.8	0.27 (1)	4.92	D-P	0 1270	0.16 (1)
E-F	-3492	0	-91.8	-91.8	0.28 (1)	4.75	P-E	-951	0
F-G	-3492	0	-91.8	-91.8	0.25 (1)	4.75	E-O	0 492	0.06 (1)
G-H	-3492	0	-91.8	-91.8	0.27 (1)	4.76	O-G	-534	0
H-I	-4347	0	-91.8	-91.8	0.25 (1)	4.40	O-H	0 259	0.03 (1)
I-J	-7318	0	-91.8	-91.8	0.33 (1)	3.42	M-H	0 2183	0.27 (1)
T-B	-2546	0	0.0	0.0	0.09 (1)	7.81	M-I	-3065	0
K-J	-8805	0	0.0	0.0	0.25 (1)	5.71	L-I	0 3477	0.31 (1)
T-S	0 0	-18.5	-18.5	0.03 (4)	10.00	L-J	0 2859	0.33 (1)	0.58 (1)
S-R	0 2814	-18.5	-18.5	0.19 (1)	10.00	B-S	0 5960	0.53 (1)	
R-Q	0 2496	-18.5	-18.5	0.19 (1)	10.00				
Q-P	0 2496	-18.5	-18.5	0.19 (1)	10.00				
P-O	0 3217	-18.5	-18.5	0.23 (1)	10.00				
O-N	0 3345	-18.5	-18.5	0.24 (1)	10.00				
N-M	0 3345	-18.5	-18.5	0.24 (1)	10.00				
M-L	0 5640	-18.5	-18.5	0.44 (1)	10.00				
L-U	0 0	-18.5	-18.5	0.21 (1)	10.00				
U-K	0 0	-18.5	-18.5	0.21 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
L	31-7-8	-5279	-5279	---	BACK	VERT	TOTAL	---	C1
U	33-8-4	-580	-580	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.0/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 085-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.07')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.13')

CS1: TC=0.33/1.00 (I-J), BC=0.44/1.00 (L-M), WB=0.84/1.00 (E-P), SS=0.14/1.00 (K-L)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (L), INPUT = 0.90
JSI METAL= 0.73 (L), INPUT = 1.00



Structural component only
DWG# T-2008033 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T34	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 11:34:38 2020 Page 2
ID:DMCubINVR6TslFoe31v6I zns1I-Qf24mc3MwC91cE0m7s76XrxdD6mB11b EKJRzLYn

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	5.0	6.0	1.50	3.00
C	TMWW-l	MT20	4.0	4.0	2.00	1.50
D	TTWW-m	MT20	5.0	6.0	2.00	1.50
E	TMWW-l	MT20	4.0	4.0		
F	TS-l	MT20	3.0	6.0		
G	TMW-w	MT20	2.0	4.0		
H	TTWW-m	MT20	5.0	6.0	2.00	2.25
I	TMWW-l	MT20	4.0	6.0	2.00	1.50
J	TMWW-p	MT20	6.0	9.0	Edge	
K	BMV1-l	MT20	6.0	9.0	Edge	0.50
L	BMWW-l	MT20	7.0	8.0	4.25	3.00
M, P, R, S						
M	BMWW-l	MT20	5.0	6.0		
N	BS-l	MT20	5.0	6.0		
O	BMWW-l	MT20	5.0	6.0		
Q	BS-l	MT20	5.0	6.0		
T	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2008033 72


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408316	T35	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2018 Mitek Industries, Inc. Thu Apr 30 10:05:26 2020 Page 1

ID:DMCubINVR6tSIfoe31v61_zns11-uZWHe5uRpIzPzQkOAUyW?MLzQ_r3kRFsqxILdPzLa9L

1-3-8 0-0 2-9-8 1-6-0 6-4-14 10-10-14 6-0-8 16-11-4 17-2-8 18-11-4 3-4 1-6-12 1-6-14 23-6-2 6-4-14 29-11-0 31-7-8 33-11-4 34-5-0 35-8-8
1-3-8 2-9-8 1-6-0 6-4-14 10-10-14 6-0-8 3-4 1-6-12 1-6-14 23-6-2 6-4-14 29-11-0 31-7-8 33-11-4 34-5-0 35-8-8
Scale = 1/8" = 1'-0"

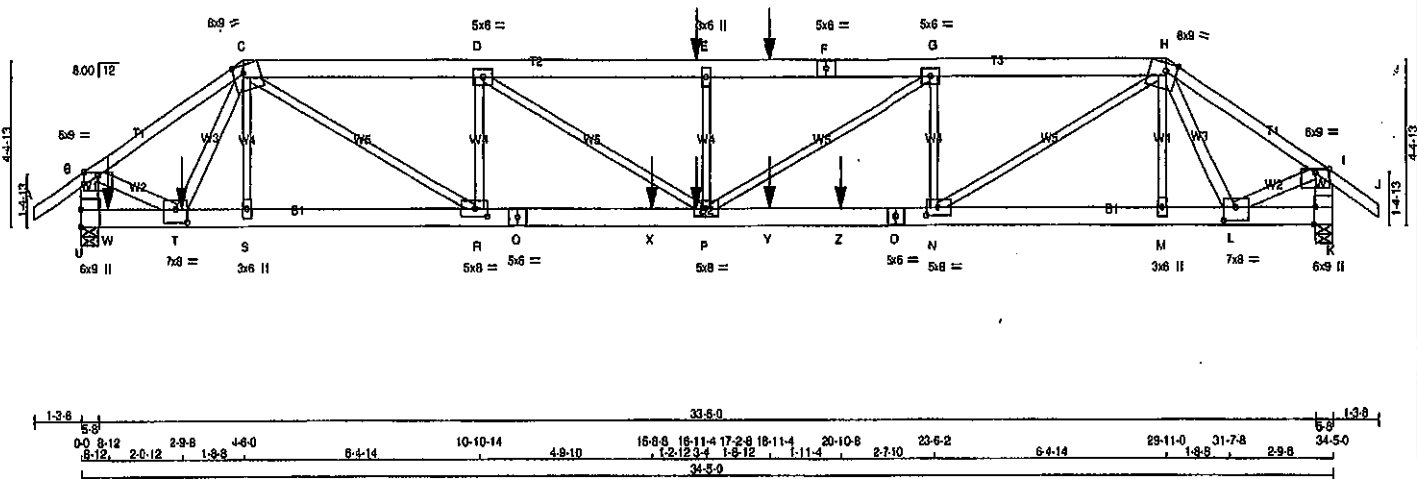

TOTAL WEIGHT = 2 X 178 = 356 lb

LUMBER	SIZE	LUMBER	DESCR.
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - F	2x6	DRY	No.2
F - H	2x6	DRY	No.2
H - J	2x4	DRY	No.2
U - B	2x6	DRY	No.2
K - I	2x6	DRY	No.2
U - Q	2x6	DRY	No.2
Q - O	2x6	DRY	No.2
O - K	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
L - I	2x4	DRY	No.2
B - T	2x4	DRY	No.2
T - O	2x4	DRY	No.2
H - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	12	TOP
H-J	12	TOP
C-F	12	SIDE (183.1)
F-H	12	TOP
U-B	12	TOP
K-I	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
U-Q	12	SIDE (0.0)
Q-O	12	SIDE (183.1)
O-K	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	1	6
2x4	1	6

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT 7874	HORZ 0	DOWN 7874	UP 0
U	7874	0	0	5-8
K	3710	0	3710	0

UNFACTORED REACTIONS

	1ST LCASE	MAX/MIN	COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
U	5554	3728 / 0	0 / 0	0 / 0	0 / 0	1822 / 0	0 / 0	
K	2615	1768 / 0	0 / 0	0 / 0	0 / 0	849 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.14 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MAX. UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 35	-91.8	-91.8 0.07 (1)	10.00	S-C	0 / 428	0.05 (1)
B-C	-8031 / 0	-91.8	-91.8 0.51 (1)	3.14	M-H	0 / 134	0.02 (4)
C-D	-9185 / 0	-91.8	-91.8 0.30 (1)	3.85	L-I	0 / 3411	0.30 (1)
D-E	-10772 / 0	-91.8	-91.8 0.32 (1)	3.56	B-T	0 / 7145	0.83 (1)
E-F	-10772 / 0	-91.8	-91.8 0.38 (1)	3.53	T-C	0 / 1764	0.16 (1)
F-G	-10772 / 0	-91.8	-91.8 0.36 (1)	3.53	H-L	-1428 / 0	0.17 (1)
G-H	-8408 / 0	-91.8	-91.8 0.27 (1)	4.02	C-R	0 / 3749	0.46 (1)
H-I	-3832 / 0	-91.8	-91.8 0.26 (1)	4.80	N-G	-2204 / 0	0.29 (1)
I-J	0 / 35	-91.8	-91.8 0.07 (1)	10.00	R-D	-1690 / 0	0.22 (1)
U-B	-7249 / 0	0.0	0.0 0.26 (1)	5.56	P-G	0 / 2789	0.35 (1)
K-I	-3633 / 0	0.0	0.0 0.13 (1)	7.37	D-P	0 / 1898	0.23 (1)
					P-E	-727 / 0	0.10 (1)
U-W	0 / 0	-18.5	-18.5 0.19 (1)	10.00			
W-T	0 / 0	-18.5	-18.5 0.19 (1)	10.00			
T-S	0 / 5967	-18.5	-18.5 0.58 (1)	10.00			
S-R	0 / 5978	-18.5	-18.5 0.45 (1)	10.00			
R-Q	0 / 9185	-18.5	-18.5 0.83 (1)	10.00			
Q-X	0 / 9185	-18.5	-18.5 0.83 (1)	10.00			
X-P	0 / 9185	-18.5	-18.5 0.83 (1)	10.00			
P-Y	0 / 8408	-18.5	-18.5 0.84 (1)	10.00			
Y-Z	0 / 8408	-18.5	-18.5 0.84 (1)	10.00			
Z-O	0 / 8408	-18.5	-18.5 0.84 (1)	10.00			
O-N	0 / 8408	-18.5	-18.5 0.84 (1)	10.00			
N-M	0 / 3795	-18.5	-18.5 0.38 (1)	10.00			
M-L	0 / 3792	-18.5	-18.5 0.39 (1)	10.00			
L-K	0 / 0	-18.5	-18.5 0.05 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	16-11-4	-115	-115	---	FRONT	VERT	TOTAL	---	C1
P	18-11-4	-23	-23	---	FRONT	VERT	TOTAL	---	C1
T	2-9-8	-4435	-4435	---	BACK	VERT	TOTAL	---	C1
V	18-11-4	-115	-115	---	FRONT	VERT	TOTAL	---	C1
W	8-12	-563	-563	---	BACK	VERT	TOTAL	---	C1
X	15-8-8	-1259	-1259	---	FRONT	VERT	TOTAL	---	C1
Y	18-11-4	-23	-23	---	FRONT	VERT	TOTAL	---	C1
Z	20-10-8	-1006	-1006	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. O.C.

LOADING IN PLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.15")
CALCULATED VERT. DEFL.(LL) = L/989 (0.28")
ALLOWABLE DEFL.(TL) = L/360 (1.15")
CALCULATED VERT. DEFL.(TL) = L/881 (0.47")

CSI: TC=0.51/1.00 (B-C:1), BC=0.94/1.00 (N-P:1),
WB=0.67/1.00 (H-N:1), SL=0.38/1.00 (P-R:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MIN	MAX	MIN
MT20	618	354
	1667	788
	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (N) (INPUT = 0.90)
JSI METAL = 0.84 (G) (INPUT = 1.00)



Structural component only
DWG# T-2008034

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T35	1	2	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:05:28 2020 Page 2

ID:DMCubINVR6TsiFoe3iv8! zns1I-uZWHe5uRpIPzQkOAUvw?MILzQ r3kRFsqxILdPzLa9L

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	8.0	9.0	Edge	
C	TTWW-m	MT20	8.0	9.0	2.50	3.50
D	TMVW-l	MT20	5.0	8.0		
E	TMVW-w	MT20	3.0	8.0		
F	TS-l	MT20	5.0	8.0		
G	TMVW-l	MT20	5.0	8.0		
H	TTWW-m	MT20	8.0	9.0	2.50	3.50
I	TMVW-p	MT20	8.0	9.0	Edge	
K	BMV-l	MT20	8.0	9.0	Edge	0.50
L	BMVW-l	MT20	7.0	8.0	4.25	3.75
M	BMVW-w	MT20	3.0	8.0		
N	BMVW-l	MT20	5.0	8.0	2.50	3.75
O	BS-l	MT20	5.0	8.0		
P	BMVW-l	MT20	5.0	8.0		
Q	BS-l	MT20	5.0	8.0		
R	BMVW-l	MT20	5.0	8.0	2.50	3.75
S	BMVW-w	MT20	3.0	8.0		
T	BMVW-l	MT20	7.0	8.0	4.25	3.75
U	BMV-l	MT20	6.0	9.0	5.50	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2008034 92


JOB NAME 408316	TRUSS NAME T36	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 16:05:28 2020 Page 1

ID:DMCubINVR6TsIFoe31v6I_zns11-uZWHe5URpIFzQkOAUyw?MLVh_zkTVsqxILdPzLa9L

Scale = 1:59.5

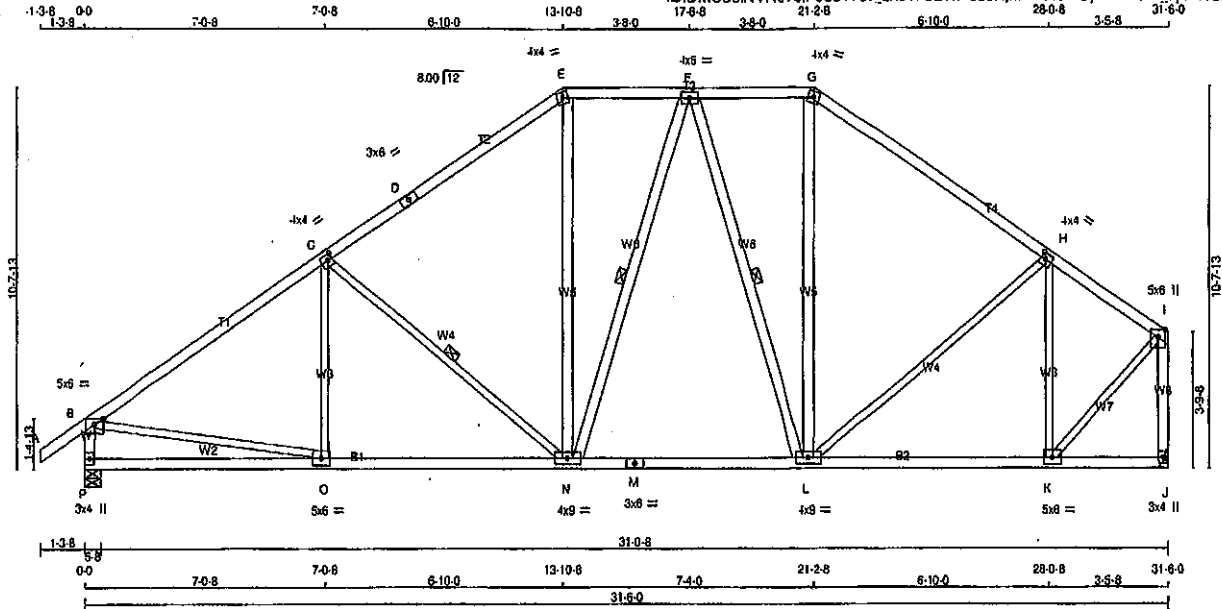

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
P - B	2x4	DRY	No.2
J - I	2x4	DRY	No.2
P - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
N - E	2x4	DRY	No.2
N - F	2x4	DRY	No.2
L - G	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	HORZ	DOWN	HORZ
P 1862	0	1862	0
J 1736	0	1736	0
A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3'-8".			

UNFACTORED REACTIONS			
1ST LOASE	SNOW	LIVE	PERM.LIVE
JT COMBINED	SNOW	LIVE	PERM.LIVE
P 1315	876/0	0/0	0/0
J 1228	808/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.87 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, F-N, F-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC) (C)
FR-TO			
A-B	0:35	-91.8	-91.8 0.12 (1)
B-C	-2083/0	-91.8	-91.8 0.75 (1)
C-D	-1612/0	-91.8	-91.8 0.67 (1)
D-E	-1612/0	-91.8	-91.8 0.67 (1)
E-F	-1311/0	-91.8	-91.8 0.17 (1)
F-G	-1177/0	-91.8	-91.8 0.16 (1)
G-H	-1442/0	-91.8	-91.8 0.58 (1)
H-I	-1142/0	-91.8	-91.8 0.43 (1)
P-B	-1809/0	0.0	0.0 0.19 (1)
J-I	-1719/0	0.0	0.0 0.41 (1)
P-O	0:0	-18.5	-18.5 0.21 (4)
O-N	0:1762	-18.5	-18.5 0.39 (1)
N-M	0:1313	-18.5	-18.5 0.32 (1)
M-L	0:1313	-18.5	-18.5 0.32 (1)
L-K	0:1002	-18.5	-18.5 0.27 (4)
K-J	0:0	-18.5	-18.5 0.13 (4)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.05")
CALCULATED VERT. DEFL.(LL) = L/899 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (1.05")
CALCULATED VERT. DEFL.(TL) = L/899 (0.14")

CSI: TC=0.75/1.00 (B-C:1), BC=0.39/1.00 (N-O:1), WB=0.53/1.00 (H-K:1), SS=0.26/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PLI) (PLI)
MAX MIN MAX MIN
MT20 518 354 1607 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (B) (INPUT = 0.90)
JSI METAL = 0.45 (I) (INPUT = 1.00)



Structural component only
DWG# T-2008035

JOB NAME 408316	TRUSS NAME T37	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 M Tek Industries, Inc. Thu Apr 30 10:05:28 2020 Page 1		ID:DMCubINVRStFoe31vdl_zns1l-M4lsRv3a3Xq2uzM1REvvyu0hOHDTP?2bVv8zLa9K	
		20-8-15		27-11-0	

Scale = 1:61.2

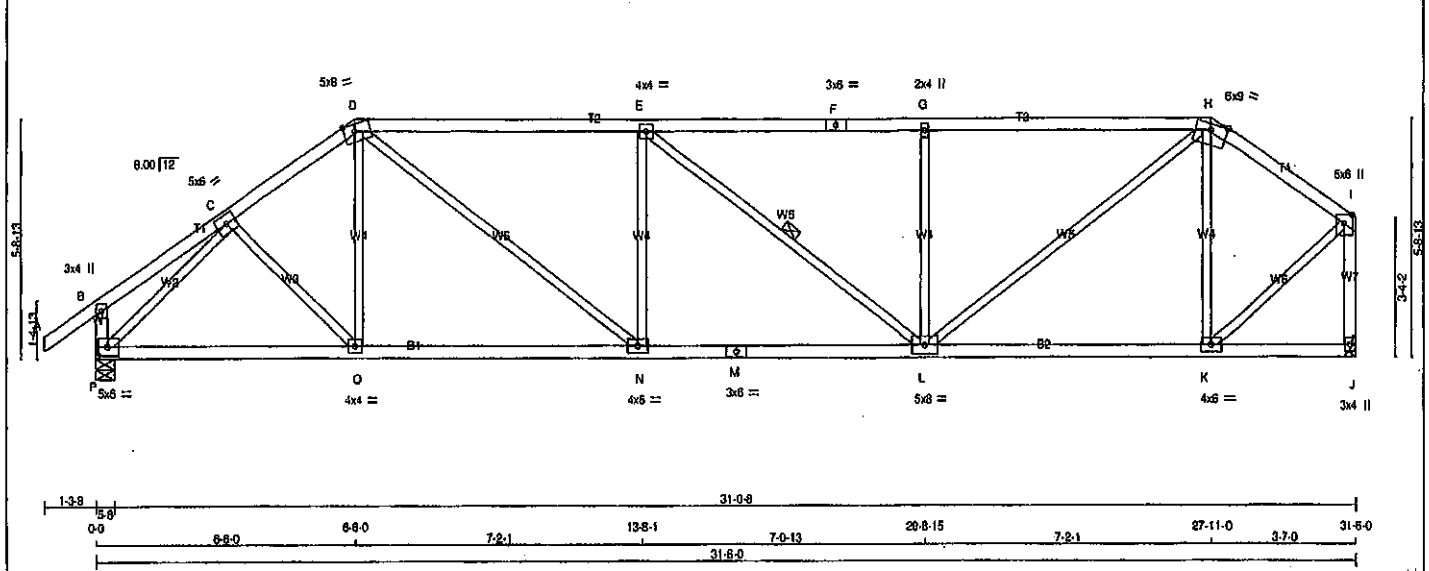

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - I	2x4	DRY	No.2	SPF	
I - J	2x4	DRY	No.2	SPF	
J - K	2x4	DRY	No.2	SPF	
K - L	2x4	DRY	No.2	SPF	
L - M	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	

EXCEPT
DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-t	MT20	5.0	6.0		
D	TTWW-m	MT20	5.0	8.0	2.00	3.25
E	TMVW-t	MT20	4.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMVW-w	MT20	2.0	4.0		
H	TTWW-m	MT20	6.0	9.0	Edge	
I	TMVW-p	MT20	5.0	6.0	Edge	
J	BMV-t+p	MT20	3.0	4.0		
K	BMVW-t	MT20	4.0	6.0		
L	BMVW-t	MT20	5.0	8.0		
M	BS-t	MT20	3.0	6.0		
N	BMVW-t	MT20	4.0	6.0		
O	BMVW-t	MT20	4.0	4.0		
P	BMVW-t	MT20	5.0	6.0	2.50	2.75

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	UPLIFT	IN-SX
P	1882	0	1882	0
J	1738	0	1738	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3'-6".

UNFACTORED REACTIONS	1ST CASE	MAX/MIN. COMPONENT REACTIONS
	COMBINED	SNOW
JT	1315	876 / 0
P	1228	808 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.
1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CS1 (LC)	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
A-B	0.135	-91.8	-91.8	0.12 (1)	10.00
B-C	0.118	-91.8	-91.8	0.13 (1)	10.00
C-D	-2023 / 0	-91.8	-91.8	0.18 (1)	4.60
D-E	-2504 / 0	-91.8	-91.8	0.99 (1)	3.25
E-F	-2355 / 0	-91.8	-91.8	0.93 (1)	3.41
F-G	-2355 / 0	-91.8	-91.8	0.99 (1)	3.41
G-H	-2355 / 0	-91.8	-91.8	0.93 (1)	3.42
H-I	-1257 / 0	-91.8	-91.8	0.23 (1)	5.47
P-B	-246 / 0	0.0	0.0	0.03 (1)	7.81
J-I	-1720 / 0	0.0	0.0	0.33 (1)	6.35
P-O	0.1588	-18.5	-18.5	0.37 (1)	10.00
O-N	0.1687	-18.5	-18.5	0.38 (1)	10.00
N-M	0.2594	-18.5	-18.5	0.50 (1)	10.00
M-L	0.2594	-18.5	-18.5	0.50 (1)	10.00
L-K	0.1029	-18.5	-18.5	0.27 (4)	10.00
K-J	0.0	-18.5	-18.5	0.14 (4)	10.00

TOTAL WEIGHT = 129 LB (M)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.05")
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.05")
CALCULATED VERT. DEFL.(TL) = L/999 (0.25")

CSI: TC=0.98/1.00 (D-E:1), BC=0.50/1.00 (L-N:1), WB=0.74/1.00 (C-P:1), SSI=0.31/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.90 (C) (INPUT = 0.90)
JSI METAL = 0.82 (M) (INPUT = 1.00)

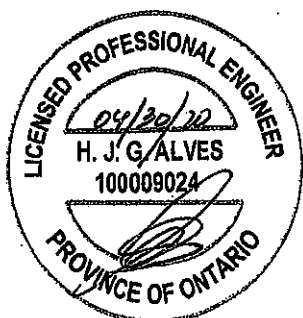


Structural component only
DWG# T-2008036

JOB NAME 408316	TRUSS NAME T38	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Famarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:05:30 2020 Page 1

ID:DMCubINVR0Tsifoe31v6l_zns1l-qxd13mVLNih2YzBNyTRAQHxne6COU9HFESHlzLa9J

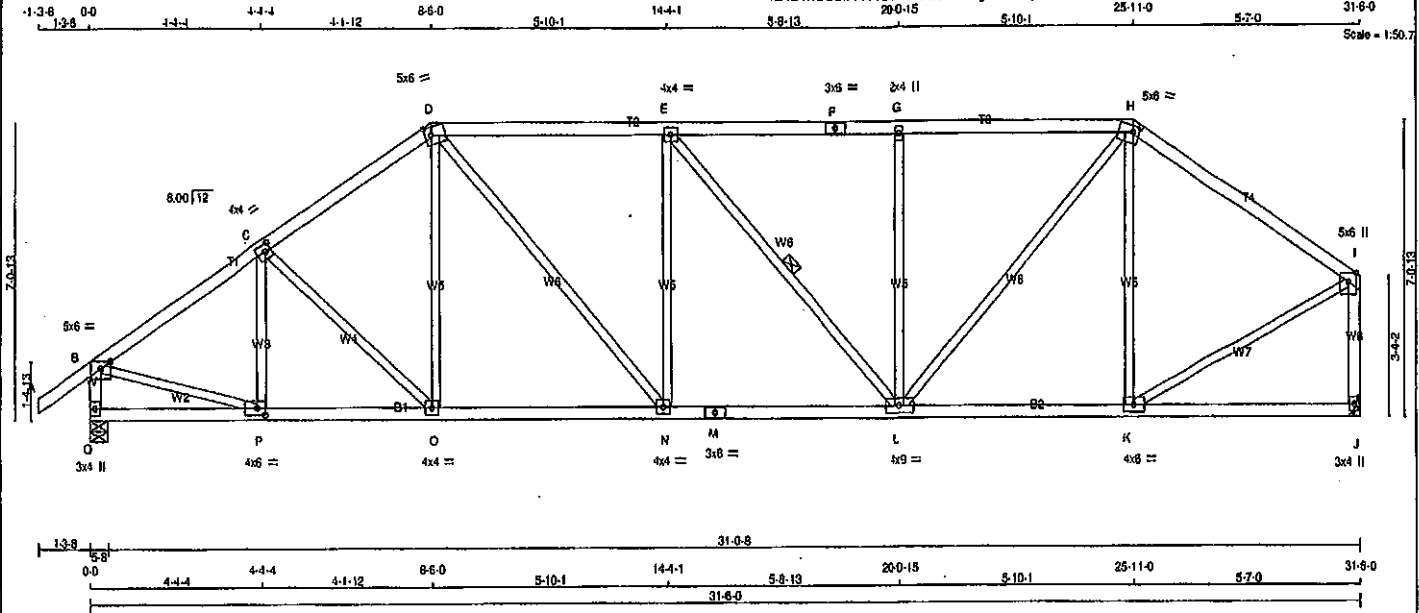

TOTAL WEIGHT = 139 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - F	2x4	DRY	No.2	SPF		
F - H	2x4	DRY	No.2	SPF		
H - I	2x4	DRY	No.2	SPF		
I - J	2x4	DRY	No.2	SPF		
J - K	2x4	DRY	No.2	SPF		
K - L	2x4	DRY	No.2	SPF		
L - M	2x4	DRY	No.2	SPF		
M - J	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMW-p	MT20	5.0	6.0	Edge	
C	TMW-w	MT20	4.0	4.0	2.00	1.50
D	TTW-w	MT20	5.0	6.0	2.25	1.75
E	TMW-t	MT20	4.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMW-w	MT20	2.0	4.0		
H	TTW-w	MT20	5.0	6.0	1.75	1.75
I	TMW-w	MT20	5.0	6.0	Edge	
J	BMV-t	MT20	3.0	4.0		
K	BMW-w	MT20	4.0	6.0		
L	BMW-w	MT20	4.0	6.0		
M	BS-t	MT20	3.0	6.0		
N	BMW-w	MT20	4.0	6.0		
O	BMW-w	MT20	4.0	6.0		
P	BMW-w	MT20	4.0	6.0	2.00	2.25
Q	BMV-t	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT. 1862	DOWN 1862	0	0
Q	HORZ. 0	HORZ. 0	5-8	5-8
J	MECHANICAL	MECHANICAL	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
Q	COMBINED	1315	876 / 0	0 / 0	0 / 0	439 / 0	0 / 0
J		1228	808 / 0	0 / 0	0 / 0	422 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.14 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-L

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED GSI (LC)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED GSI (LC)
FR-TO	A-B	0:35	-91.8	-91.8	0.12 (1)	10.00	P-C	-342:0	0.09 (1)
	B-C	-2003:0	-91.8	-91.8	0.35 (1)	4.44	C-O	-122:0	0.07 (1)
	C-D	-1949:0	-91.8	-91.8	0.34 (1)	4.49	O-D	0:181	0.04 (4)
	D-E	-2053:0	-91.8	-91.8	0.54 (1)	4.14	D-N	0:692	0.16 (1)
	E-F	-1915:0	-91.8	-91.8	0.53 (1)	4.27	N-E	-414:0	0.36 (1)
	F-G	-1915:0	-91.8	-91.8	0.53 (1)	4.27	E-L	-215:0	0.12 (1)
	G-H	-1914:0	-91.8	-91.8	0.52 (1)	4.28	L-G	-576:0	0.50 (1)
	H-I	-1442:0	-91.8	-91.8	0.60 (1)	4.87	L-H	0:1103	0.25 (1)
	I-J	-1825:0	0.0	0.0	0.19 (1)	6.20	K-H	-515:0	0.44 (1)
	J-K	-1695:0	0.0	0.0	0.32 (1)	6.38	B-P	0:1738	0.39 (1)
							K-I	0:1357	0.31 (1)
	Q-P	0:0	-18.5	-18.5	0.07 (4)	10.00			
	P-O	0:1687	-18.5	-18.5	0.33 (1)	10.00			
	O-N	0:1601	-18.5	-18.5	0.32 (1)	10.00			
	N-M	0:2053	-18.5	-18.5	0.40 (1)	10.00			
	M-L	0:2053	-18.5	-18.5	0.40 (1)	10.00			
	L-K	0:1190	-18.5	-18.5	0.28 (1)	10.00			
	K-J	0:0	-18.5	-18.5	0.15 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6	PSF
DL	= 6.0	PSF
BOT CH. LL	= 0.0	PSF
DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.05')
CALCULATED VERT. DEFL.(LL) = L/999 (0.09')
ALLOWABLE DEFL.(TL) = L/360 (1.05')
CALCULATED VERT. DEFL.(TL) = L/999 (0.17')

CSI: TC=0.80/1.00 (H-I:1), BC=0.40/1.00 (L-N:1), WB=0.50/1.00 (G-L:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.59 (M) (INPUT = 1.00)



Structural component only
DWG# T-2008037

JOB NAME 408316	TRUSS NAME T39	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Thu Apr 30 10:05:31 2020 Page 1
 ID:DMCubINVR6TslFoe31v6l_zns1fH8BPH7wk6gnYHC7194Ti_NzSNB?yqfIWv_7DkzLa9l
 1-3-6 0-0 5-4-4 5-4-4 5-1-12 10-6-0 6-8-8 17-2-8 23-11-0 27-7-3 3-10-12 31-6-0
 1-3-6 0-0 5-4-4 5-4-4 5-1-12 10-6-0 6-8-8 17-2-8 23-11-0 27-7-3 31-6-0
 Scale = 1/81.0

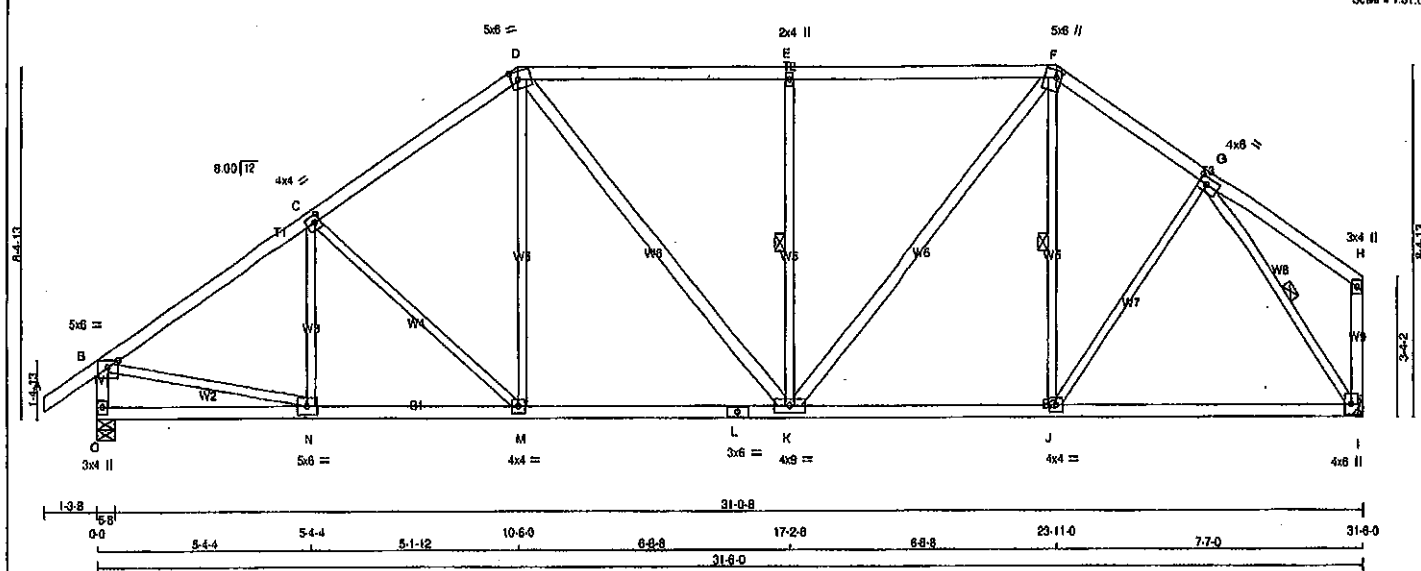

LUMBER

N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
O - B	2x4	DRY	No.2	SPF
I - H	2x4	DRY	No.2	SPF
O - L	2x4	DRY	No.2	SPF
L - I	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
D - K	2x4	DRY	No.2	SPF
K - F	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	6.0	Edge	
C TMVW-l	MT20	4.0	4.0	2.00	1.50
D TTWW-m	MT20	5.0	6.0	2.25	2.00
E TMVW-w	MT20	2.0	4.0		
F TTWW+m	MT20	5.0	6.0	2.00	1.50
G TMVW-l	MT20	4.0	6.0	2.00	2.50
H TMV-p	MT20	3.0	4.0		
I BMVW-l-p	MT20	4.0	6.0		
J BMVW-l	MT20	4.0	4.0		
K BMVWW-l	MT20	4.0	9.0		
L BS-l	MT20	3.0	6.0		
M BMVW-l	MT20	4.0	4.0		
N BMVW-l	MT20	5.0	6.0		
O BMV-l-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
VT	1882	0	1882	0
HT	1738	0	1738	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
O	1315	876 / 0	0 / 0	0 / 0	0 / 0	439 / 0	0 / 0
I	1228	808 / 0	0 / 0	0 / 0	0 / 0	422 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.32 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-K, F-J, G-I.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO	0 / 35	91.8	91.8 0.12 (1)	N-C	-250 / 0	0.09 (1)	
A-B	-2050 / 0	91.8	91.8 0.40 (1)	C-M	-302 / 0	0.28 (1)	
B-C	-1844 / 0	91.8	91.8 0.38 (1)	M-D	0 / 315	0.07 (1)	
C-D	-1740 / 0	91.8	91.8 0.59 (1)	D-K	0 / 362	0.06 (1)	
D-E	-1740 / 0	91.8	91.8 0.59 (1)	K-E	-758 / 0	0.34 (1)	
E-F	-1527 / 0	91.8	91.8 0.19 (1)	F-F	0 / 771	0.12 (1)	
F-G	0 / 22	91.8	91.8 0.21 (1)	J-F	-125 / 39	0.08 (1)	
G-H	-1819 / 0	0.0	0.0 0.19 (1)	J-G	0 / 338	0.03 (1)	
H-I	-136 / 0	0.0	0.0 0.03 (1)	G-N	0 / 1766	0.40 (1)	
				G-I	-1870 / 0	0.57 (1)	
O-N	0 / 0	-18.5	-18.5 0.11 (4)				
N-M	0 / 1731	-18.5	-18.5 0.36 (1)				
M-L	0 / 1510	-18.5	-18.5 0.32 (1)				
L-K	0 / 1510	-18.5	-18.5 0.32 (1)				
K-J	0 / 1249	-18.5	-18.5 0.35 (4)				
J-I	0 / 1057	-18.5	-18.5 0.33 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.05")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
 ALLOWABLE DEFL.(TL) = L/360 (1.05")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.58/1.00 (D-E:1), BC=0.38/1.00 (M-N:1), WB=0.57/1.00 (G-I:1), SS=0.30/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 818 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 6.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.90)
 JSI METAL= 0.48 (I) (INPUT = 1.00)

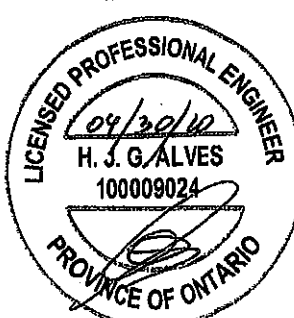


Structural component only
 DWG# T-2008038

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408316	T40	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:05:31 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns1H8BPH7wK6gnYHC7194T1_NzSQB7mxs91Ww_7DkzLa9

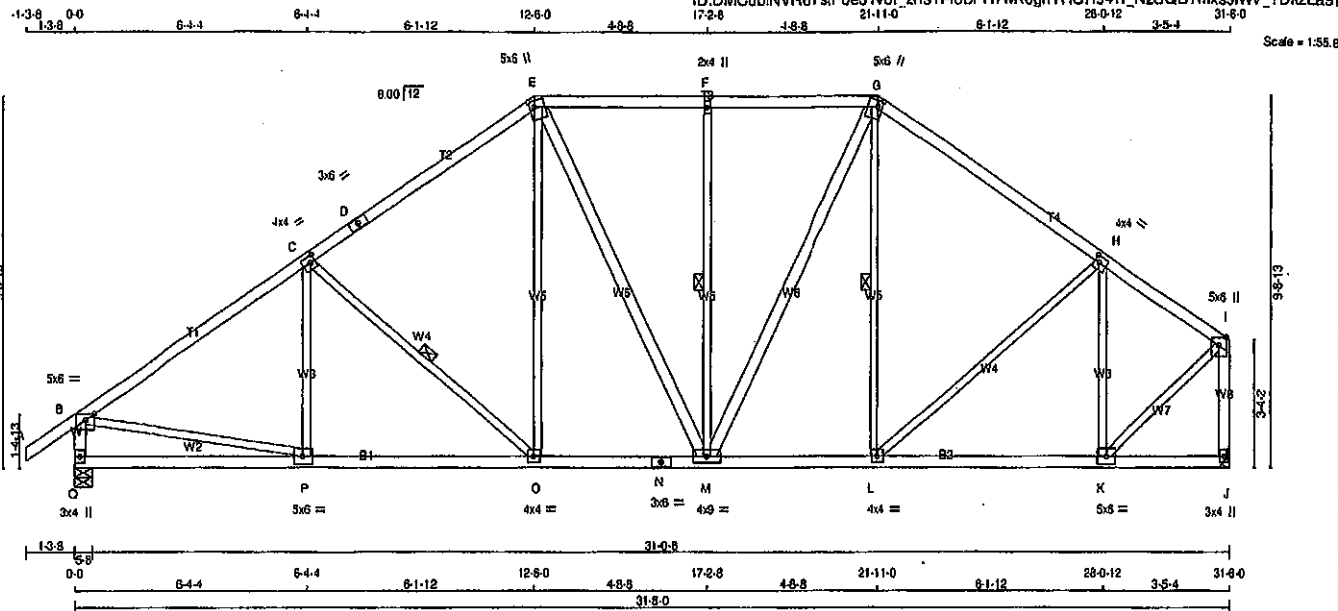

TOTAL WEIGHT = 158 lb
[MIF]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
E - H	2x4	DRY	No.2
I - L	2x4	DRY	No.2
M - P	2x4	DRY	No.2
Q - J	2x4	DRY	No.2
K - N	2x4	DRY	No.2
O - R	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
E - M	2x4	DRY	No.2
M - G	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
Q	1882	0	1882	0	0	5-8	5-8
J	1735	0	1735	0	0	MECHANICAL	
A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.							

UNFACTORED REACTIONS							
1ST CASE	MAX MIN	COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERMALIVE	WIND	DEAD	SOIL
Q	1315	876/0	0/0	0/0	0/0	439/0	0/0
J	1228	806/0	0/0	0/0	0/0	422/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.11 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, F-M, G-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
A-B	0 - 35	-91.8 -91.8 0.12 (1)	10.00	P-C	-188/49	0.08 (1)	
B-C	-2088/0	-91.8 -91.8 0.59 (1)	4.11	O-E	-474/0	0.22 (1)	
C-D	-1711/0	-91.8 -91.8 0.53 (1)	4.49	E-M	0/410	0.09 (1)	
D-E	-1711/0	-91.8 -91.8 0.53 (1)	4.49	M-F	0/155	0.02 (1)	
E-F	-1463/0	-91.8 -91.8 0.28 (1)	5.11	F-G	-525/0	0.33 (1)	
F-G	-1463/0	-91.8 -91.8 0.28 (1)	5.11	G-H	0/513	0.08 (1)	
G-H	-1514/0	-91.8 -91.8 0.48 (1)	4.82	H-I	-33/68	0.02 (4)	
H-I	-1232/0	-91.8 -91.8 0.35 (1)	5.35	I-J	0/219	0.05 (1)	
I-J	-1814/0	0.0 0.0 0.19 (1)	6.21	J-K	-839/0	0.41 (1)	
J-K	-1717/0	0.0 0.0 0.33 (1)	6.35	K-L	0/1778	0.40 (1)	
K-L	0/0	-18.5 -18.5 0.19 (4)	10.00				
L-M	0/1751	-18.5 -18.5 0.37 (1)	10.00				
M-N	0/1394	-18.5 -18.5 0.28 (1)	10.00				
N-O	0/1394	-18.5 -18.5 0.28 (1)	10.00				
O-P	0/1234	-18.5 -18.5 0.27 (1)	10.00				
P-Q	0/1068	-18.5 -18.5 0.24 (1)	10.00				
Q-R	0/0	-18.5 -18.5 0.11 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.05")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (1.05")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CSI: TC=0.59/1.00 (B-C:1), BC=0.37/1.00 (O-P:1), WB=0.41/1.00 (H-K:1), SS=0.23/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MT20 618 354 1687 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.90 (E) (INPUT = 0.90)
JSI METAL=0.49 (I) (INPUT = 1.00)




Structural component only
DWG# T-2008039

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408316	T41	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 M Tek Industries, Inc. Thu Apr 30 10:05:32 2020 Page 1

ID:DMCubNVR6TsiFoe31v6l_zns11-mKloUTxyl_vPvMxjo_xWbWvPbKkgJISIZImAzLa9H

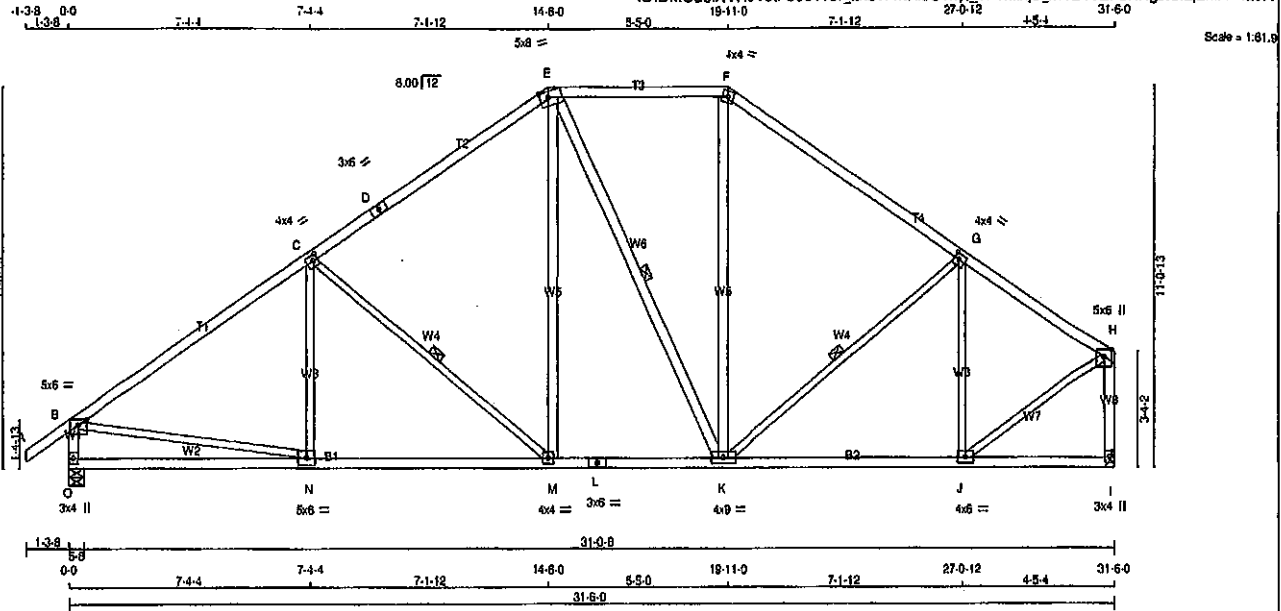

TOTAL WEIGHT = 155 lb (M/F)

LUMBER	N L O. A RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
O - B	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
O - L	2x4	DRY	No.2	SPF	
L - I	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	
M - E	2x4	DRY	No.2	SPF	
E - K	2x4	DRY	No.2	SPF	
K - F	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (Tables in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge	
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TS-t	MT20	3.0	6.0		
E	TTW-m	MT20	5.0	8.0	2.00	3.00
F	TTW-m	MT20	4.0	4.0		
G	TMVW-t	MT20	4.0	4.0	2.00	1.50
H	TMVW-p	MT20	5.0	6.0	Edge	
I	BMV1-p	MT20	3.0	4.0		
J	BMVW-t	MT20	4.0	6.0		
K	BMVW-t	MT20	4.0	6.0		
L	BS-t	MT20	3.0	6.0		
M	BMVW-t	MT20	4.0	4.0		
N	BMVW-t	MT20	5.0	6.0		
O	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

REACTIONS

JT	VERT	HORZ	UPLIFT	IN-SX	IN-SX
O	1882	0	1882	0	0
I	1736	0	1736	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I MINIMUM BEARING LENGTH AT JOINT I = 3'-8"

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
O	1315	876	0	0	0	439	0
I	1228	808	0	0	0	422	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-M, E-K, G-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO	0.7/35	0.7/35	0.7/35	0.7/35	0.7/35	0.7/35	0.7/35
A-B	-2060	-91.8	-91.8	0.12 (1)	10.00	N-C	-102
B-C	-1593	-91.8	-91.8	0.63 (1)	3.72	C-M	-634
C-D	-1593	-91.8	-91.8	0.73 (1)	4.28	M-E	-0
D-E	-1593	-91.8	-91.8	0.73 (1)	4.28	E-K	-176
E-F	-1191	-91.8	-91.8	0.37 (1)	5.41	K-F	0
F-G	-1482	-91.8	-91.8	0.64 (1)	4.60	K-G	-5
G-H	-1376	-91.8	-91.8	0.49 (1)	4.91	J-G	-689
O-B	-1807	0.0	0.0	0.19 (1)	6.22	B-N	0
I-H	-1710	0.0	0.0	0.32 (1)	6.36	J-H	0
O-N	0	-18.5	-18.5	0.25 (4)	10.00		
N-M	0	-18.5	-18.5	0.41 (1)	10.00		
M-L	0	-18.5	-18.5	0.29 (1)	10.00		
L-K	0	-18.5	-18.5	0.29 (1)	10.00		
K-J	0	-18.5	-18.5	0.28 (1)	10.00		
J-I	0	-18.5	-18.5	0.18 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.05")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (1.05")
CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CS: TC=0.89/1.00 (B-C:1), BC=0.41/1.00 (M-N:1), WB=0.44/1.00 (G-J:1), SS=0.27/1.00 (B-G:1)

OOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1686

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (B) (INPUT = 0.90)
JSI METAL = 0.55 (H) (INPUT = 1.00)



Structural component only
DWG# T-2008040


JOB NAME 408316	TRUSS NAME T42	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:05:33 2020 Page 1

ID:DMCubINVR6TslFos31v6I_zns11-EWJAhoyael2GWVH7GVVA3o2uN7bqPh8bzDT6ldzLa9G

Scale = 1:30.5

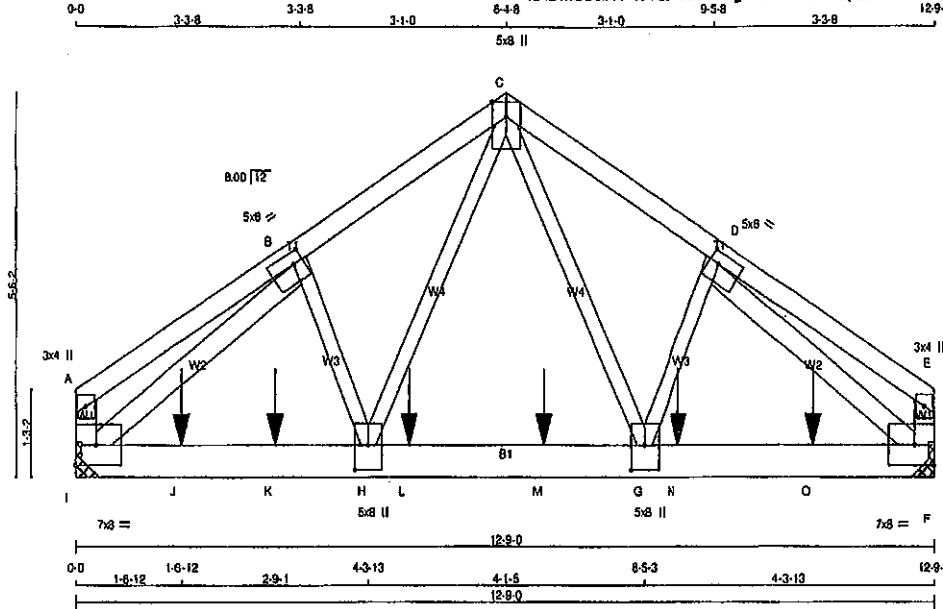

TOTAL WEIGHT = 2 X 64 = 128 lb (M)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF		
C - E	2x4 DRY	No.2	SPF		
I - A	2x4 DRY	No.2	SPF		
F - E	2x4 DRY	No.2	SPF		
I - F	2x6 DRY	1650F 1.5E	SPF		
ALL WEBS EXCEPT	2x3 DRY	No.2	SPF		
I - B	2x4 DRY	No.2	SPF		
D - F	2x4 DRY	No.2	SPF		

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	12	TOP
C-E	12	TOP
I-A	12	TOP
F-E	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
I-F	12	SIDE (0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	
2x4	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS								
FACTORED			MAXIMUM FACTORED			INPUT	REQD	
JT	GROSS REACTION		GROSS REACTION		BRG	BRG		
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
I	6128	0	6128	0	0	MECHANICAL		
F	5588	0	5588	0	0	MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I.F. MINIMUM BEARING LENGTH AT JOINT I = 4-0, JOINT F = 4-0.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
I	4327	2870 / 0	0 / 0	0 / 0	0 / 0	1457 / 0	0 / 0	
F	3947	2618 / 0	0 / 0	0 / 0	0 / 0	1329 / 0	0 / 0	

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.70 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	MAX. FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	-3 / 1	-91.8	-91.8	0.08 (1)	10.00	C-G	0 / 3327
B-C	-6393 / 0	-91.8	-91.8	0.24 (1)	3.70	G-D	0 / 857
C-D	-6154 / 0	-91.8	-91.8	0.22 (1)	3.78	H-C	0 / 3862
D-E	-2 / 3	-91.8	-91.8	0.08 (1)	10.00	B-H	0 / 903
I-A	-142 / 0	0.0	0.0	0.01 (1)	7.81	I-B	-6839 / 0
F-E	-138 / 0	0.0	0.0	0.01 (1)	7.81	D-F	-6568 / 0
I-J	0 / 4984	-18.5	-18.5	0.71 (1)	10.00		
J-K	0 / 4984	-18.5	-18.5	0.71 (1)	10.00		
K-H	0 / 4984	-18.5	-18.5	0.71 (1)	10.00		
H-L	0 / 3878	-18.5	-18.5	0.58 (1)	10.00		
L-M	0 / 3878	-18.5	-18.5	0.58 (1)	10.00		
M-G	0 / 3878	-18.5	-18.5	0.58 (1)	10.00		
G-N	0 / 4802	-18.5	-18.5	0.82 (1)	10.00		
N-O	0 / 4802	-18.5	-18.5	0.82 (1)	10.00		
O-F	0 / 4802	-18.5	-18.5	0.82 (1)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	FACE	DIR.	TYPE	HEEL	CONN.
J	1-6-12	-1718	-1718	---	FRONT	VERT	TOTAL	---
K	2-11-4	-1718	-1718	---	FRONT	VERT	TOTAL	---
L	4-11-4	-1718	-1718	---	FRONT	VERT	TOTAL	---
M	6-11-4	-1718	-1718	---	FRONT	VERT	TOTAL	---
N	8-11-4	-1718	-1718	---	FRONT	VERT	TOTAL	---
O	10-11-4	-1718	-1718	---	FRONT	VERT	TOTAL	---

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2016, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.43")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.43")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.24/1.00 (B-C:1), BC=0.71/1.00 (H-I:1), WB=0.78/1.00 (B-I:1), SSI=0.88/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (B) (INPUT = 0.90)
JSI METAL= 0.82 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008041 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408316	T42	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington


Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Thu Apr 30 10:05:33 2020 Page 2

ID:DMCubINVR6TsFge31v6l zn81l-EWJAhoYae12GWVH7GVVA3o2uN2bqPh8bzDT6ldzLa9G

PLATES (tables in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B	TMWW-l	MT20	5.0	8.0	2.00	1.75
C	TTWW+p	MT20	5.0	8.0	Edge	
D	TMWW-l	MT20	5.0	8.0	2.00	1.75
E	TMV+p	MT20	3.0	4.0		
F	BMVW1-l	MT20	7.0	8.0	Edge	
G	BMWW+l	MT20	5.0	8.0	4.25	2.50
H	BMWW+l	MT20	5.0	8.0	4.25	2.50
I	BMVW1-l	MT20	7.0	8.0	Edge	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

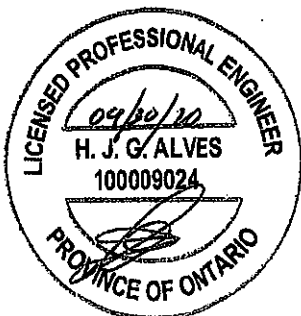


Structural component only.
DWG# T-2008041 3/2

JOB NAME 408316	TRUSS NAME T43S	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:05:34 2020 Page 1

ID:DMCubINVR8TsiFoe31v8I_zns11-jitYv8zCPbA78IsKqC0Pc0b5zP3m8HLkCICq3zLa9F

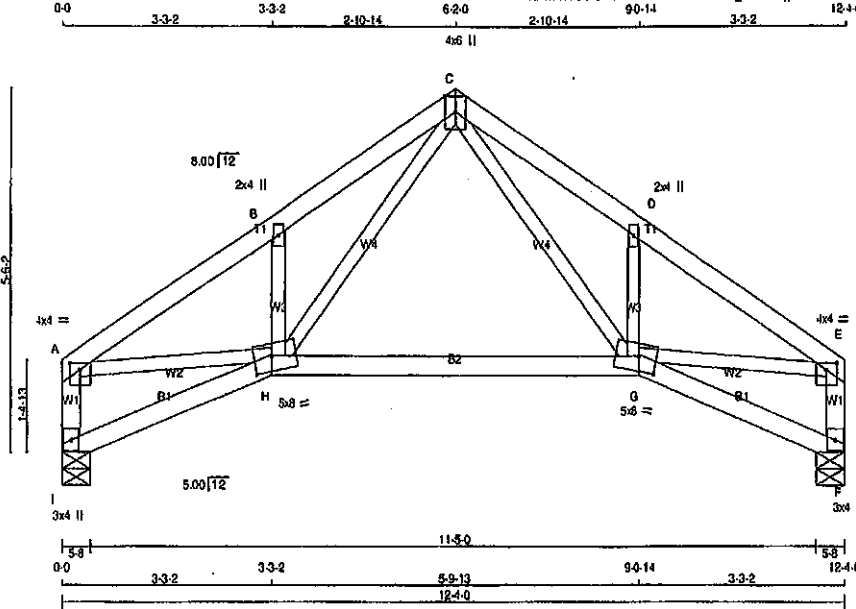

Scale: 3/8"=1'

TOTAL WEIGHT = 50 lb (M/F)

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
I - A	2x4	DRY	No.2
F - E	2x4	DRY	No.2
I - H	2x4	DRY	No.2
H - G	2x4	DRY	No.2
G - F	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
SPF			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW-p	MT20	4.0	4.0	1.25 2.00
B	TMVW-w	MT20	2.0	4.0	
C	TTWW-p	MT20	4.0	6.0	Edge
D	TMVW-w	MT20	2.0	4.0	
E	TMVW-p	MT20	4.0	4.0	1.25 2.00
F	BMV1-p	MT20	3.0	4.0	
G	BBWWW-m	MT20	5.0	8.0	2.75 3.25
H	BBWWW-m	MT20	5.0	8.0	2.75 3.25
I	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG	
	VERT	HORZ	DOWN	UPLIFT	IN-SX
I	680	0	680	0	5-8
F	680	0	680	0	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
I	481	316/0	0/0	0/0	0/0	165/0	0/0
F	481	316/0	0/0	0/0	0/0	165/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.13 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED	MEMB.	MAX. FACTORED
	FORCE (LBS)		FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	-973 / 0	C-G	0 / 551
B-C	-1008 / 0	G-D	-339 / 0
C-D	-1008 / 0	D-H	0 / 551
D-E	-973 / 0	H-I	-339 / 0
E-F	-850 / 0	I-A	0 / 822
F-G	-850 / 0	G-E	0 / 822
I-H	0 / 0	H-G	-18.5 -18.5 0.06 (4) 10.00
H-G	0 / 502	G-F	-18.5 -18.5 0.22 (4) 10.00
G-F	0 / 0		-18.5 -18.5 0.06 (4) 10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ORC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.41")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.41")
CALCULATED VERT. DEFL.(TL) = L/999 (0.09")

CSI: TC=0.12/1.00 (A-B:1), BC=0.22/1.00 (G-H:4), WB=0.18/1.00 (A-H:1), SS=0.11/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1687 785 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.88 (A) (INPUT = 0.90)
JSI METAL= 0.28 (A) (INPUT = 1.00)



Structural component only
DWG# T-2008042

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T43SX	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 M/Tek Industries, Inc. Thu Apr 30 10:05:34 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-jlYv8zCPbA78IsKqC0Pc0b4eP3i8G7kCICqg3zLa9F

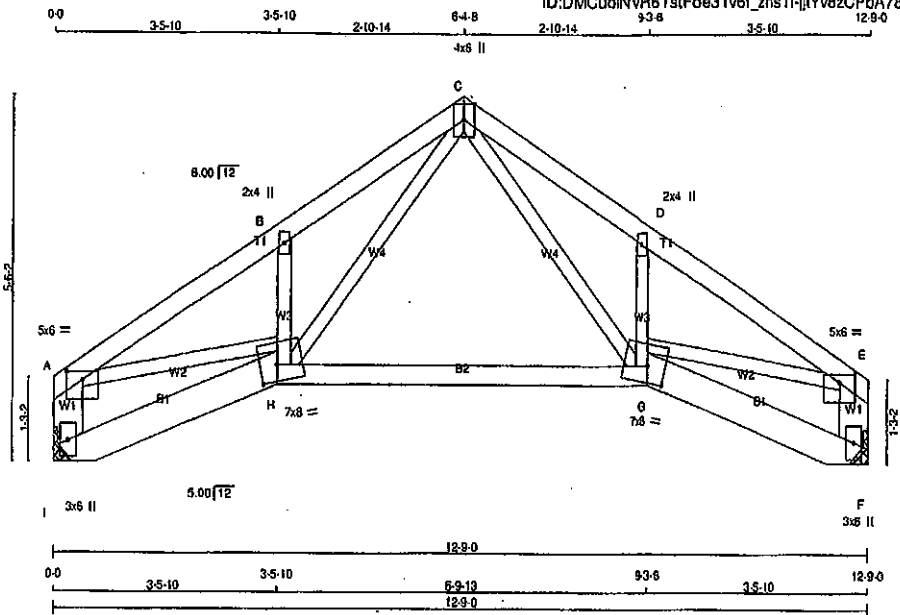

TOTAL WEIGHT = 57 kN
(M/F)

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
I - A	2x6	DRY	No.2
F - E	2x6	DRY	No.2
I - H	2x6	DRY	No.2
H - G	2x4	DRY	No.2
G - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMW+p	MT20	5.0	6.0	1.50	3.00
B	TMW+w	MT20	2.0	4.0		
C	TTWW+p	MT20	4.0	6.0	Edge	
D	TMW+w	MT20	2.0	4.0		
E	TMW+p	MT20	5.0	6.0	1.50	3.00
F	BMV1+p	MT20	3.0	8.0		
G	BBWWW-m	MT20	7.0	8.0	3.00	3.25
H	BBWWW-m	MT20	7.0	8.0	3.00	3.25
I	BMV1+p	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED		MAXIMUM FACTORED		INPUT		REQD	
	GROSS	REACTION	GROSS	REACTION	BRG	BRG	BRG	BRG
I	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
I	703	0	703	0	0	MECHANICAL		
F	703	0	703	0	0	MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I, F. MINIMUM BEARING LENGTH AT JOINT I = 3-8, JOINT F = 3-8.

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	497	328 / 0	0 / 0	0 / 0	0 / 0	171 / 0	0 / 0
F	497	328 / 0	0 / 0	0 / 0	0 / 0	171 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.89 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	-1084 / 0	-91.8 -91.8 0.14 (1)	5.92	C-G	0 / 631	0.14 (1)	
B-C	-1119 / 0	-91.8 -91.8 0.11 (1)	5.89	G-D	-351 / 0	0.06 (1)	
C-D	-1119 / 0	-91.8 -91.8 0.11 (1)	5.89	H-Q	0 / 631	0.14 (1)	
D-E	-1084 / 0	-91.8 -91.8 0.14 (1)	5.92	H-B	-351 / 0	0.06 (1)	
I-A	-671 / 0	0.0 0.0 0.04 (1)	7.61	A-H	0 / 918	0.21 (1)	
F-E	-671 / 0	0.0 0.0 0.04 (1)	7.61	G-E	0 / 918	0.21 (1)	
I-H	0 / 0	-18.5 -18.5 0.03 (4)	10.00				
H-G	0 / 544	-18.5 -18.5 0.23 (4)	10.00				
G-F	0 / 0	-18.5 -18.5 0.03 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, OBC 2012, ABO 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.43")
CALCULATED VERT. DEFL.(LL) = L/899 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.43")
CALCULATED VERT. DEFL.(TL) = L/899 (0.10")

CSI: TC=0.14/1.00 (A-B:1), BC=0.23/1.00 (G-H:4), WB=0.21/1.00 (A-H:1), BS=0.12/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354 1667 788	1907 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.50 (E) (INPUT = 0.90)
JSI METAL = 0.22 (E) (INPUT = 1.00)




Structural component only
DWG# T-2008043

JOB NAME 408316	TRUSS NAME T44	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:05:35 2020 Page 1

ID:DMCubINVR6TsIFos31v6l_zns11-BvRw6UzqAvl_mprRWOwYe8D7FSoGwtcMuRxyDMVzLa9E

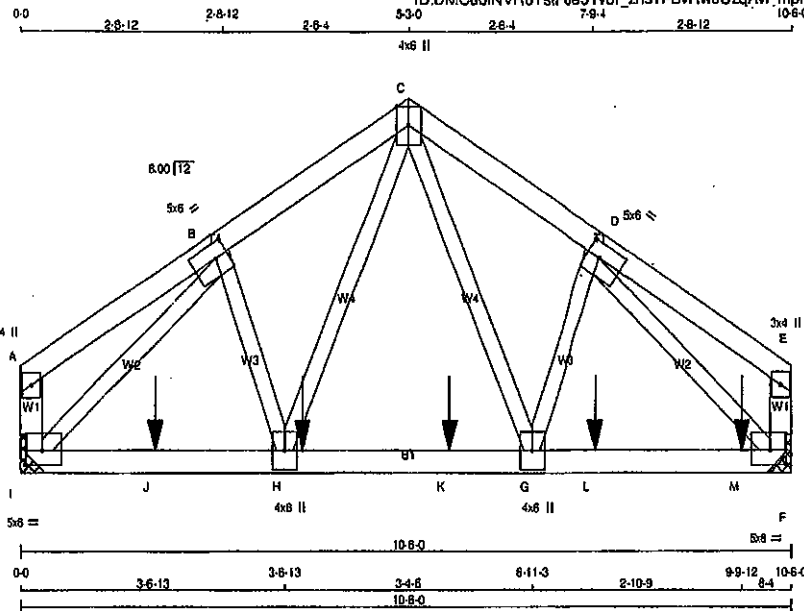

Scale = 1/2" = 1'-0"

TOTAL WEIGHT = 2 X 47 = 93 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - E	2x4	DRY	No.2	SPF		
I - A	2x4	DRY	No.2	SPF		
F - E	2x4	DRY	No.2	SPF		
I - F	2x4	DRY	2100F 1.0E	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		

EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C	12	TOP
C-E	12	TOP
I-A	12	TOP
F-E	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
I-F	12	SIDE (0.0)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B	TMVW-i	MT20	5.0	6.0	2.25	2.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	UPLIFT	IN-SX
I	4453	0	4453	0
F	5297	0	5297	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. F. MINIMUM BEARING LENGTH AT JOINT I = 4-0, JOINT F = 4-0.

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
I	3145	2088 / 0	0 / 0	0 / 0	0 / 0	1059 / 0	0 / 0
F	3742	2481 / 0	0 / 0	0 / 0	0 / 0	1261 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.45 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED	MAX
MEMB.	FORCE (LBS)	FORCE (LBS)	FROM	TO	CS1 (LC)	UNBRAC	LENGTH	FORCE (LBS)	CS1 (LC)
FR-TO									
A-B	-6 / 0	-91.8	-91.8	0.07 (1)	10.00	C-G	0 / 2469	0.31 (1)	
B-C	-4431 / 0	-91.8	-91.8	0.14 (1)	4.45	G-D	0 / 1006	0.12 (1)	
C-D	-4422 / 0	-91.8	-91.8	0.14 (1)	4.45	H-C	0 / 2491	0.31 (1)	
D-E	-5 / 0	-91.8	-91.8	0.07 (1)	10.00	B-H	0 / 1009	0.12 (1)	
I-A	-128 / 0	0.0	0.0	0.01 (1)	7.81	I-B	-4953 / 0	0.85 (1)	
F-E	-127 / 0	0.0	0.0	0.01 (1)	7.81	D-F	-4943 / 0	0.65 (1)	
I-J	0 / 3361	-18.5	-18.5	0.74 (1)	10.00				
J-H	0 / 3361	-18.5	-18.5	0.74 (1)	10.00				
H-K	0 / 2833	-18.5	-18.5	0.68 (1)	10.00				
K-G	0 / 2833	-18.5	-18.5	0.68 (1)	10.00				
G-L	0 / 3354	-18.5	-18.5	0.68 (1)	10.00				
L-M	0 / 3354	-18.5	-18.5	0.68 (1)	10.00				
M-F	0 / 3354	-18.5	-18.5	0.68 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
H	3-9-12	-1718	-1718	---	FRONT	VERT	TOTAL	---	C1
J	1-9-12	-1718	-1718	---	FRONT	VERT	TOTAL	---	C1
K	5-9-12	-1718	-1718	---	FRONT	VERT	TOTAL	---	C1
L	7-9-12	-1718	-1718	---	FRONT	VERT	TOTAL	---	C1
M	9-9-12	-1721	-1721	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (0.35")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.08")
ALLOWABLE DEFL.(TL) = 1/360 (0.35")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.12")

CS1: TC=0.14/1.00 (B-C:1), BC=0.74/1.00 (H-I:1), WB=0.85/1.00 (B-I:1), SS=0.84/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	818	354	1687
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.80 (D) (INPUT = 0.80)
JSI METAL = 0.57 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008044 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T44	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:05:35 2020 Page 2

ID:DMCubINVR6TstFoe31v6I zns1I-BvRw6UzoAvI mpRWOwYe8D7FSoGwldMuRXyDMVzLa9E

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
C	TTWW+p	MT20	4.0	6.0	Edge	
D	TMWW-I	MT20	5.0	6.0	2.25	2.00
E	TMV+p	MT20	3.0	4.0		
F	BMVW1-I	MT20	5.0	6.0	2.25	2.75
G	BMVW+I	MT20	4.0	6.0		
H	BMVW+I	MT20	4.0	6.0		
I	BMVW1-I	MT20	5.0	6.0	2.25	2.75

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.




Structural component only
DWG# T-2008044 *yr*

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:05:36 2020 Page 1
ID:DMCubINVR6TslFoe31v8l_zns1l-I5?IKq_SkDQrNz?iyd3thRgNFCIRcCU1lBhmvyzLa9D

Scale = 1:20.6

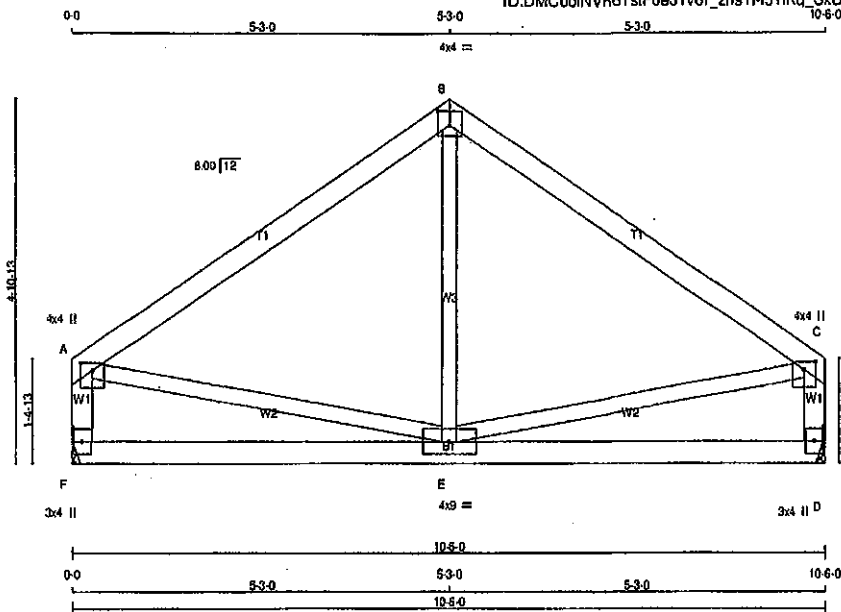

TOTAL WEIGHT = 41 lb




Structural component only
DWG# T-2008045

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408316	T45S	1	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:05:38 2020 Page 1

ID:DMCubINVR6TstFae31v6l_zns1l-45?IKg_SxDOqNz7ydz3lhRgRQCmpc8Q1fBhmvyzLa9D

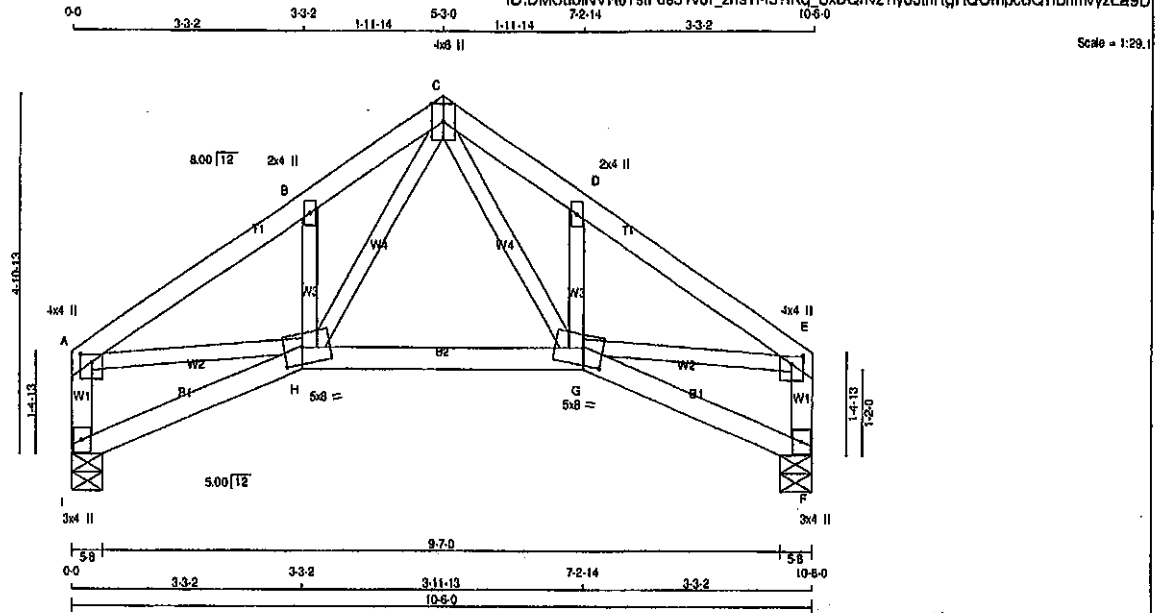

TOTAL WEIGHT = 44 lb
(M/F)

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
I - A	2x4	DRY	No.2
F - E	2x4	DRY	No.2
I - H	2x4	DRY	No.2
H - G	2x4	DRY	No.2
G - F	2x4	DRY	No.2

ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (tables in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TMW+w	MT20	2.0	4.0		
C	TTWW+p	MT20	4.0	6.0	Edge	
D	TMW+w	MT20	2.0	4.0		
E	TMVW+p	MT20	4.0	4.0	1.25	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BBWWW-m	MT20	5.0	8.0	2.75	3.25
H	BBWWW-m	MT20	5.0	8.0	2.75	3.25
I	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ
JT	579	0	579	0
I	579	0	579	0
F	579	0	579	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN COMPONENT REACTIONS	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
I	409	289 / 0	0 / 0	0 / 0	0 / 0	0 / 0	141 / 0	0 / 0
F	409	289 / 0	0 / 0	0 / 0	0 / 0	0 / 0	141 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	
FR-TO		FROM TO		FR-TO			
A-B	-778 / 0	-91.8 -91.8 0.12 (1)	6.25	C-G	0 / 448	0.10 (1)	
B-C	-813 / 0	-91.8 -91.8 0.09 (1)	6.25	G-D	-299 / 0	0.05 (1)	
C-D	-813 / 0	-91.8 -91.8 0.09 (1)	6.25	H-C	0 / 448	0.10 (1)	
D-E	-778 / 0	-91.8 -91.8 0.12 (1)	6.25	H-E	-299 / 0	0.05 (1)	
I-A	-549 / 0	0.0 0.0 0.06 (1)	7.81	A-H	0 / 657	0.15 (1)	
F-E	-549 / 0	0.0 0.0 0.06 (1)	7.81	G-E	0 / 657	0.15 (1)	
I-H	0 / 0	-18.5 -18.5 0.06 (4)	10.00				
H-G	0 / 435	-18.5 -18.5 0.12 (4)	10.00				
G-F	0 / 0	-18.5 -18.5 0.06 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL =	8.0	PSF
BOT CH.	LL = 0.0	PSF
DL =	7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF 8CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPO 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.35")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.35")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.04")

CSI: TC=0.12/1.00 (D-E:1), BC=0.12/1.00 (G-H:4),
WB=0.15/1.00 (A-H:1), SSI=0.11/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1687
	788	1987	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (A) (INPUT = 0.80)
JSI METAL = 0.20 (A) (INPUT = 1.00)



Structural component only
DWG# T-2008046


JOB NAME 408317	TRUSS NAME T50	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 \$ Oct 28 2019 Mitek Industries, Inc. Thu Apr 30 10:50:31 2020 Page 1

ID:DMCubINVR6TslF0e31v6l_zns11-FaL7yLbxGFySC7XgK7vsPloepaSwYy8jNz017EzLZV6

1-3-8 0-0 5-10-8 5-10-8 5-10-10 11-9-2 5-9-8 17-5-8 5-9-8 23-3-14 5-10-10 29-2-8 35-1-0 38-4-8 1-3-8
Scale = 1:57.5

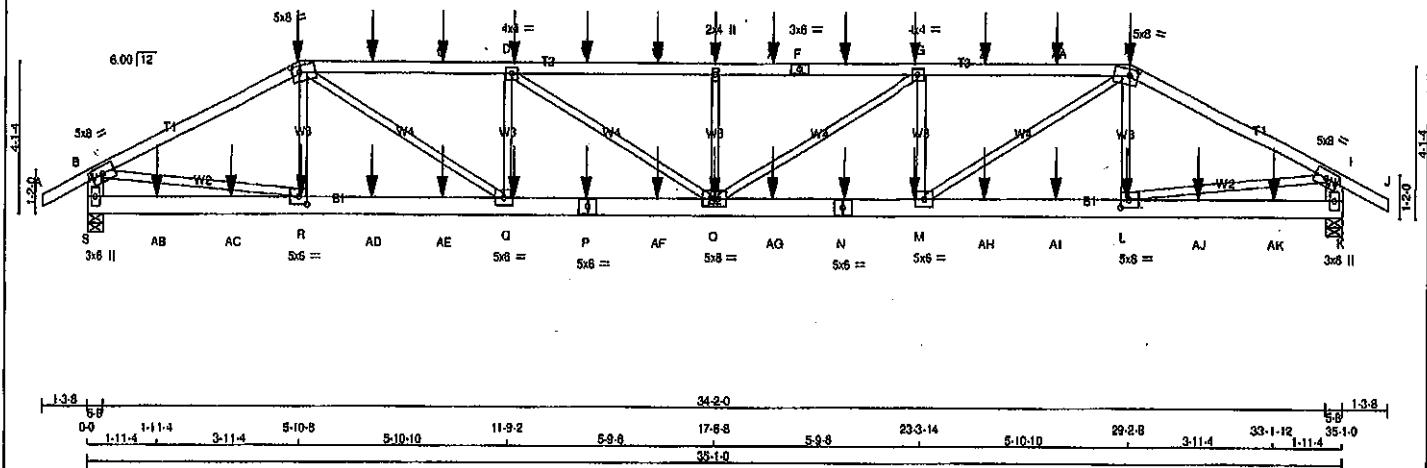

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - F	2x4	DRY No.2	SPF
F - H	2x4	DRY No.2	SPF
H - J	2x4	DRY No.2	SPF
S - B	2x6	DRY No.2	SPF
K - I	2x6	DRY No.2	SPF
S - P	2x6	DRY No.2	SPF
P - N	2x6	DRY No.2	SPF
N - K	2x6	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	12	SIDE(61.0)
C-F	12	SIDE(61.0)
F-H	12	SIDE(61.0)
H-J	12	SIDE(61.0)
S-B	12	TOP
K-I	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S-P	12	SIDE(183.1)
P-N	12	SIDE(183.1)
N-K	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-8 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PILES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	IN-SX	IN-SX
S	3303	0	5-8	5-8
K	3303	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
S	2336	1528/0 0/0 0/0 0/0 808/0 0/0
K	2336	1528/0 0/0 0/0 0/0 808/0 0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.89 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)
FR-TO		FROM TO		FR-TO		
A-B	0/28	-91.8 -91.8 0.07 (1)	10.00	R-C	-377/33	0.05 (1)
B-C	-5023/0	-91.8 -91.8 0.52 (1)	3.89	C-Q	0/3072	0.38 (1)
C-T	-7076/0	-91.8 -91.8 0.74 (1)	3.11	Q-D	-1459/0	0.19 (1)
T-U	-7076/0	-91.8 -91.8 0.74 (1)	3.11	D-O	0/916	0.11 (1)
U-O	-7076/0	-91.8 -91.8 0.74 (1)	3.11	O-E	-921/0	0.10 (1)
D-V	-7846/0	-91.8 -91.8 0.80 (1)	2.89	Q-G	0/916	0.11 (1)
V-W	-7846/0	-91.8 -91.8 0.80 (1)	2.89	M-G	-1459/0	0.19 (1)
W-E	-7846/0	-91.8 -91.8 0.80 (1)	2.89	M-H	0/3072	0.38 (1)
E-X	-7846/0	-91.8 -91.8 0.80 (1)	2.89	L-H	-378/33	0.05 (1)
X-F	-7846/0	-91.8 -91.8 0.80 (1)	2.89	B-R	0/4528	0.58 (1)
F-Y	-7846/0	-91.8 -91.8 0.80 (1)	2.89	L-I	0/4528	0.58 (1)
Y-G	-7846/0	-91.8 -91.8 0.80 (1)	2.89			
G-Z	-7076/0	-91.8 -91.8 0.74 (1)	3.11			
Z-AA	-7076/0	-91.8 -91.8 0.74 (1)	3.11			
AA-H	-7076/0	-91.8 -91.8 0.74 (1)	3.11			
H-I	-5023/0	-91.8 -91.8 0.52 (1)	3.89			
I-J	0/28	-91.8 -91.8 0.07 (1)	10.00			
S-B	-3228/0	0.0 0.0 0.11 (1)	7.71			
K-I	-3227/0	0.0 0.0 0.11 (1)	7.71			

FACTORED CONCENTRATED LOADS (LBS)	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
JT	5-10-8	-414	-414	---	FRONT	VERT	---	C1
C	11-11-4	-110	-110	---	FRONT	VERT	---	C1

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2010
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 088-14
- TPIG 2011, TPIG 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.25')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/901 (0.47')

CSI: TC=0.80/1.00 (D-E:1), BC=0.53/1.00 (Q-Q:1)

WB=0.55/1.00 (B-R:1), SS=0.20/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1687 788	1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (L) (INPUT = 0.90)

JSI METAL= 0.88 (P) (INPUT = 1.00)



Structural component only
DWG# T-2008054

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ORWG NO.
408317	T50	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 5 Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:50:31 2020 Page 2

ID:DMCubINVR6TstF0a31v6I zns11-FaL7yLbxGFySC7XqK7vsPlopaSwYy8iNz017EzLZV6

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	8.0		
C	TTWW-m	MT20	5.0	8.0	2.00	2.75
D	TMVW-t	MT20	4.0	4.0		
E	TMVW-w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMVW-t	MT20	4.0	4.0		
H	TTWW-m	MT20	5.0	8.0	2.00	2.75
I	TMVW-t	MT20	5.0	8.0		
K	BMV1+p	MT20	3.0	6.0		
L	BMVW-t	MT20	5.0	8.0	2.50	2.75
M	BMVW-t	MT20	5.0	8.0		
N	BS-t	MT20	5.0	8.0		
O	BMVW-t	MT20	5.0	8.0		
P	BS-t	MT20	5.0	8.0		
Q	BMVW-t	MT20	5.0	8.0		
R	BMVW-t	MT20	5.0	8.0	2.50	2.75
S	BMV1+p	MT20	3.0	6.0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	17-8-8	-110	-110	---	FRONT	VERT	TOTAL	---	C1
G	23-1-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	29-2-8	-414	-414	---	FRONT	VERT	TOTAL	---	C1
L	29-1-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
M	23-1-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
N	21-1-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
O	17-6-8	-26	-26	---	FRONT	VERT	TOTAL	---	C1
P	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Q	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	19-1-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	21-1-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	25-1-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	27-1-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AC	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AD	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AE	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	19-1-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	25-1-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	27-1-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	31-1-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	33-1-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2008054

DRWG NO.

Scale = 1:57.1

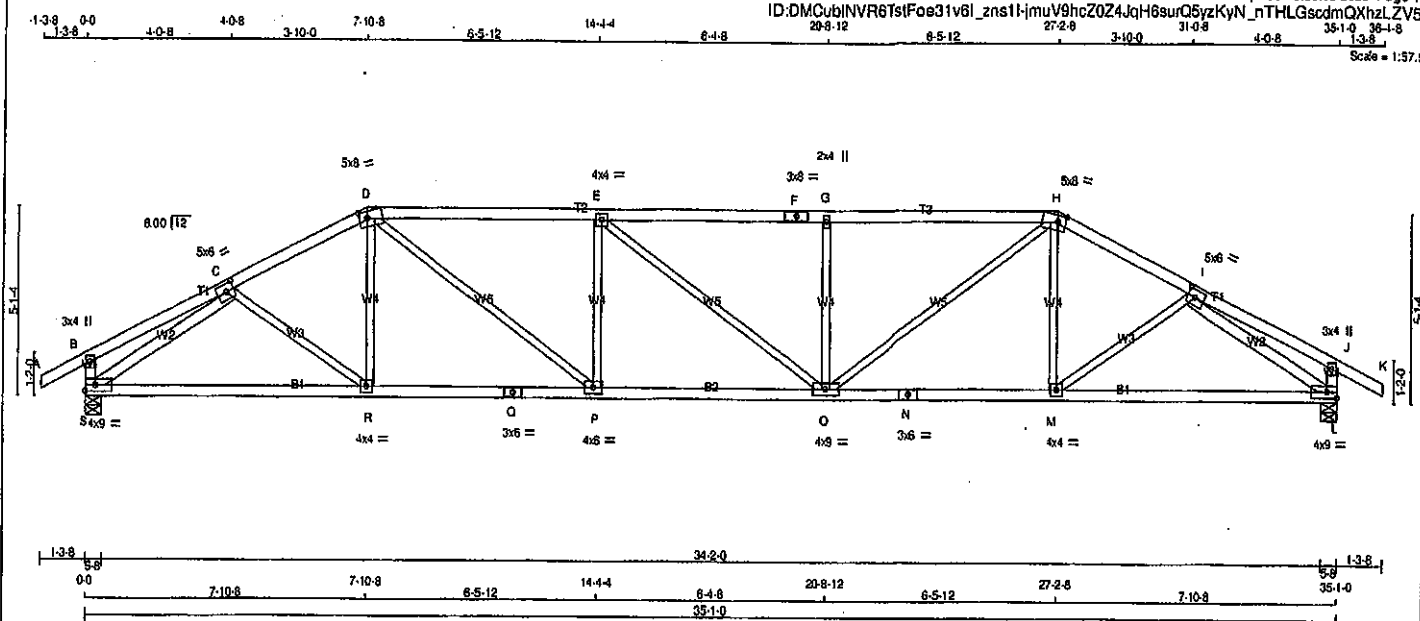

TOTAL WEIGHT = 139 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
S - C	2x4	DRY	No.2
1 - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
J	TYPE	PLATES	W	LEN	Y	X
B	TMV-w	MT20	3.0	4.0		
C	TMW-w	MT20	5.0	8.0	2.50	2.75
D	TTW-w	MT20	5.0	8.0	2.50	2.75
E	TMW-w	MT20	4.0	4.0		
F	TS-I	MT20	3.0	8.0		
G	TMW-w	MT20	2.0	4.0		
H	TTW-w	MT20	5.0	8.0	2.25	2.75
I	TMW-w	MT20	5.0	6.0	2.50	2.75
J	TMV-w	MT20	3.0	4.0		
L	BMVW-1	MT20	4.0	9.0		Edge
M	BMW-w	MT20	4.0	4.0		
N	BS-I	MT20	3.0	6.0		
O	BMWVW-w	MT20	4.0	9.0		
P	BMW-w	MT20	4.0	6.0		
Q	BS-I	MT20	3.0	6.0		
R	BMW-w	MT20	4.0	4.0		
S	BMVW-1	MT20	4.0	9.0		Edge

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARING DESIGN							
FACTORED			MAXIMUM FACTORED			INPUT	REQD
GROSS REACTION			GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
S	2059	0	2059	0	0	5-8	5-8
L	2059	0	2059	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1453	987/0	0/0	0/0	0/0	488/0	0/0
L	1453	987/0	0/0	0/0	0/0	488/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S. L.

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.95 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LX)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LO)	
FR-TO		FROM TO			FR-TO			
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00	C-R	0/93	0.03 (4)
B-C	0/16	-91.8	-91.8	0.20 (1)	10.00	R-Q	0/121	0.04 (4)
C-D	-2791/0	-91.8	-91.8	0.31 (1)	3.89	D-P	0/1258	0.29 (1)
D-E	-3492/0	-91.8	-91.8	0.93 (1)	2.95	P-E	-641/0	0.25 (1)
E-F	-3491/0	-91.8	-91.8	0.92 (1)	2.95	E-D	-2/0	0.00 (1)
F-G	-3491/0	-91.8	-91.8	0.92 (1)	2.95	O-G	-640/0	0.25 (1)
G-H	-3491/0	-91.8	-91.8	0.53 (1)	2.97	O-H	0/1258	0.28 (1)
H-I	-2791/0	-91.8	-91.8	0.31 (1)	3.89	M-H	0/121	0.04 (4)
I-J	0/18	-91.8	-91.8	0.20 (1)	10.00	M-I	0/93	0.03 (4)
J-K	0/28	-91.8	-91.8	0.12 (1)	10.00	S-C	-2986/0	0.82 (1)
S-B	-270/0	0.0	0.0	0.03 (1)	7.81	I-L	-2986/0	0.82 (1)
L-J	-270/0	0.0	0.0	0.03 (1)	7.81			
S-R	0/2411	-18.5	-18.5	0.53 (1)	10.00			
R-Q	0/2481	-18.5	-18.5	0.54 (1)	10.00			
Q-P	0/2481	-18.5	-18.5	0.54 (1)	10.00			
P-O	0/3492	-18.5	-18.5	0.84 (1)	10.00			
O-N	0/2462	-18.5	-18.5	0.54 (1)	10.00			
N-M	0/2482	-18.5	-18.5	0.54 (1)	10.00			
M-L	0/2411	-18.5	-18.5	0.53 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBCO 2018, CBC 2012, ABC 2019
- PART 9 OF CBCO 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL)= L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.41")

CSI: TC=0.93/1.00 (D-E:1), BC=0.64/1.00 (O-P:1),
WB=0.82/1.00 (I-L:1), SS=0.28/1.00 (O-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE KEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	618	354	1867	788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.89 (L) (INPUT = 0.80)
JSI METAL= 0.77 (N) (INPUT = 1.00)



Structural component only
DWG# T-2008055

JOB NAME 408317	TRUSS NAME T52	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 10:50:33 2020 Page 1
ID:DMCubINVR6tFoe31v6I_zns11-ByS1M1d8nsDARRh2RYxKUA7kO9n0rJ0rHV_37zLV4

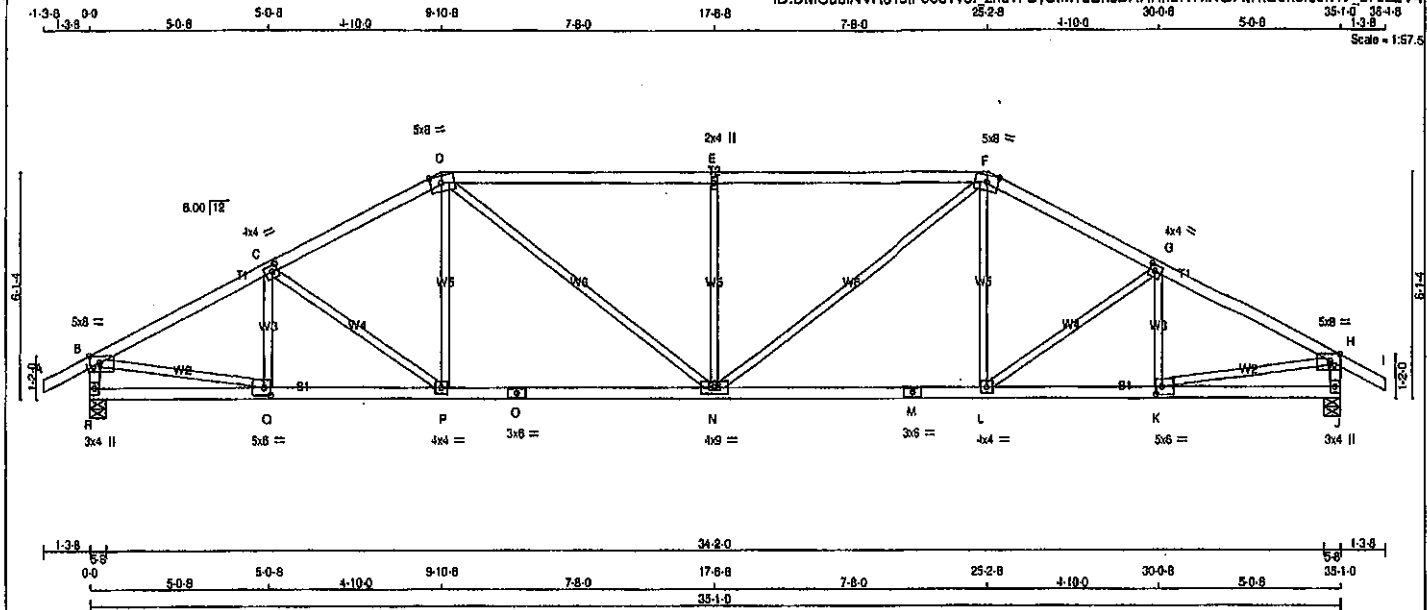

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - B	2x4	DRY	No.2
B - H	2x4	DRY	No.2
H - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge 3.50	
C	TMVW-l	MT20	4.0	4.0	2.00 1.75	
D	TTVW-m	MT20	5.0	8.0	2.25 3.75	
E	TMVW-w	MT20	2.0	4.0		
F	TTVW-m	MT20	5.0	8.0	2.25 3.75	
G	TMVW-l	MT20	4.0	4.0	2.00 1.75	
H	TMVW-p	MT20	5.0	8.0	Edge 3.50	
J	BMVl+p	MT20	3.0	4.0		
K	BMVW-l	MT20	5.0	8.0	2.50 2.00	
L	BS-l	MT20	4.0	4.0		
M	BS-l	MT20	3.0	8.0		
N	BMVW-w	MT20	4.0	4.0		
O	BS-l	MT20	3.0	8.0		
P	BMVW-l	MT20	4.0	4.0		
Q	BMVW-l	MT20	5.0	8.0	2.50 2.00	
R	BMVl+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
R	2059	0	2059	0
J	2059	0	2059	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS
	COMBINED	SNOW	LIVE
R	1453	987.0	0.0
J	1453	987.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLINE SPACING = 2.83 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO				FR-TO			
A-B	0.28	-91.8	-91.8 0.12 (1)	Q-C	-352.0	0.08 (1)	0.08 (1)
B-C	-2828.0	-91.8	-91.8 0.39 (1)	C-P	-211.0	0.13 (1)	0.13 (1)
C-D	-2879.0	-91.8	-91.8 0.37 (1)	P-D	0.248	0.06 (4)	0.06 (4)
D-E	-3044.0	-91.8	-91.8 0.36 (1)	D-N	0.838	0.19 (1)	0.19 (1)
E-F	-3044.0	-91.8	-91.8 0.36 (1)	N-F	-897.0	0.51 (1)	0.51 (1)
F-G	-2878.0	-91.8	-91.8 0.37 (1)	F-N	0.838	0.19 (1)	0.19 (1)
G-H	-2828.0	-91.8	-91.8 0.39 (1)	L-F	0.248	0.06 (4)	0.06 (4)
H-I	0.28	-91.8	-91.8 0.12 (1)	L-Q	-211.0	0.13 (1)	0.13 (1)
I-B	-2014.0	0.0	0.0 0.20 (1)	K-G	-352.0	0.08 (1)	0.08 (1)
J-H	-2014.0	0.0	0.0 0.20 (1)	B-Q	0.2584	0.58 (1)	0.58 (1)
R-Q	0.0	-18.5	-18.5 0.10 (4)	K-H	0.2584	0.58 (1)	0.58 (1)
Q-P	0.2548	-18.5	-18.5 0.50 (1)				
P-O	0.2378	-18.5	-18.5 0.49 (1)				
O-N	0.2378	-18.5	-18.5 0.49 (1)				
N-M	0.2378	-18.5	-18.5 0.49 (1)				
M-L	0.2378	-18.5	-18.5 0.49 (1)				
L-K	0.2548	-18.5	-18.5 0.50 (1)				
K-J	0.0	-18.5	-18.5 0.10 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $\frac{L^3}{960}$ (1.17")
CALCULATED VERT. DEFL.(LL) = $\frac{L^3}{999}$ (0.17")
ALLOWABLE DEFL.(TL) = $\frac{L^3}{960}$ (1.17")
CALCULATED VERT. DEFL.(TL) = $\frac{L^3}{999}$ (0.34")

CSI: TC=0.98/1.00 (D-E:1), BC=0.50/1.00 (P-Q:1), WB=0.58/1.00 (B-C:1), SB=0.34/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSB) (PLI) (PLJ)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.88 (F) (INPUT = 0.90)
JSI METAL=0.75 (C) (INPUT = 1.00)



Structural component only
DWG# T-2008056

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408317	T53	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 M&T Industries, Inc. Thu Apr 30 11:40:05 2020 Page 2

ID:DMCubINVR6TsFoe31v6I_zns1I-AiIQ7GbQI0IT?AuFYIGGkvz6OQOZMu0TFqRENszLYme

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
S	TMWW-1	MT20	5.0	6.0	2.50	2.25
C	TMWW-1	MT20	5.0	6.0		
D	TMWW-1	MT20	5.0	6.0		
E	TTWW-m	MT20	5.0	6.0	2.25	2.00
F	TMWW-1	MT20	2.0	4.0		
G	TTWW-m	MT20	5.0	6.0	2.25	2.00
H	TMWW-1	MT20	5.0	6.0		
I	TMWW-1	MT20	5.0	6.0	2.50	2.25
J	TMWW-1	MT20	6.0	6.0	2.75	3.75
L	BMV1-1	MT20	7.0	8.0	Edge	1.50
M	BMWW-1	MT20	10.0	12.0		
N	BMWW-1	MT20	5.0	6.0	2.50	2.75
O	BMWW-1	MT20	5.0	6.0		
P	BS-1	MT20	5.0	6.0		
Q	BMWW-1	MT20	5.0	6.0		
R	BS-1	MT20	5.0	6.0		
S	BMWW-1	MT20	5.0	6.0		
T	BMWW-1	MT20	5.0	6.0	2.50	2.75
U	BMWW-1	MT20	10.0	12.0		
V	TMBMWW-1-p	MT20	7.0	12.0	9.75	3.50

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

11 C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2008057 112

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408317	T54	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Thu Apr 30 10:50:38 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns1l-bX80?2f44nbkvQd7gV16pVkgB9vD8jSXfkgSzlZV1

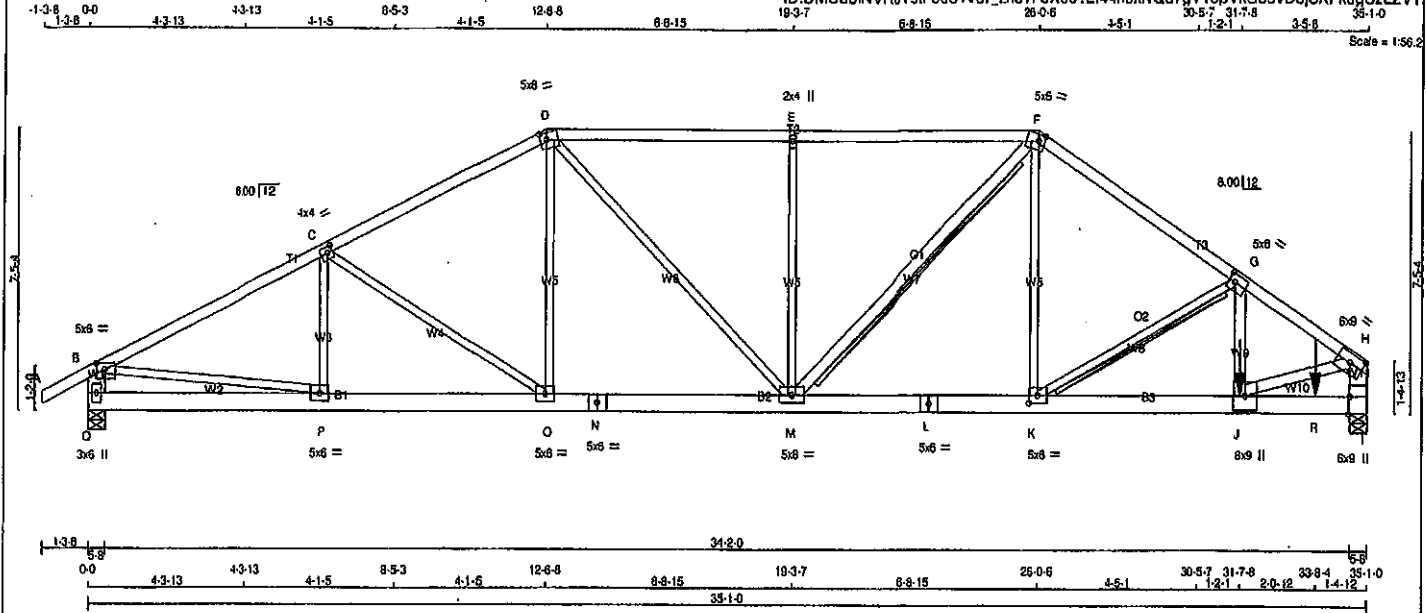

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
Q - B	2x6	DRY	No.2	SPF	
I - H	2x6	DRY	No.2	SPF	
Q - N	2x6	DRY	No.2	SPF	
N - L	2x6	DRY	No.2	SPF	
L - I	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
J - G	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
M - F	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - D 1	12	TOP
D - F 1	12	TOP
F - H 1	12	TOP
Q - B 2	12	TOP
I - H 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
Q - N 2	12	TOP
N - L 2	12	TOP
L - I 2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	SIDE(137.2)
Q - J 2	2	
2x4 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3.0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	2873	0	0	5-8
I 7885	0	7885	0	5-8

UNFACTORED REACTIONS	1ST LOASE	MAX/MIN. COMPONENT REACTIONS	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT COMBINED	1887	1256 / 0	0 / 0	0 / 0	0 / 0	631.0	0 / 0
I	5625	3736 / 0	0 / 0	0 / 0	0 / 0	1889.0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.91 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT G-K, F-M

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 80% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING	CHORDS	FACTORED	WEBS
TOTAL LOAD CASES: (4)	MAX. FACTORED	FACTORED	MAX. FACTORED
	MEMB. FORCE (LBS)	VERT. LOAD LC1 MAX (PLF) CSI (LC)	MEMB. FORCE MAX (LBS) CSI (LC)
	FR-TO	FROM TO	FR-TO
	A-B 0:28	-91.8 -91.8 0.07 (1) 10.00	P-C -350 / 0 0.05 (1)
	B-C -4025 / 0	-91.8 -91.8 0.51 (1) 4.28	C-O -377 / 0 0.20 (1)
	C-D -3735 / 0	-91.8 -91.8 0.46 (1) 4.44	O-D 0:363 0.04 (1)
	D-E -4129 / 0	-91.8 -91.8 0.56 (1) 4.14	K-F 0:2280 0.28 (1)
	E-F -4129 / 0	-91.8 -91.8 0.56 (1) 4.14	K-G -4139 / 0 0.88 (1)
	F-G -4951 / 0	-91.8 -91.8 0.40 (1) 4.05	B-P 0:3852 0.45 (1)
	G-H -9200 / 0	-91.8 -91.8 0.47 (1) 2.91	J-G 0:3850 0.35 (1)
	Q-B -2803 / 0	0.0 0.0 0.09 (1) 7.81	H-H 0:7983 0.71 (1)
	I-H -7441 / 0	0.0 0.0 0.27 (1) 5.49	M-F -8 / 0 0.00 (4)
			D-M 0:1175 0.15 (1)
			M-E -753 / 0 0.38 (1)
	Q-P 0:0	-18.5 -18.5 0.05 (4) 10.00	
	P-O 0:3828	-18.5 -18.5 0.27 (1) 10.00	
	O-N 0:3316	-18.5 -18.5 0.25 (1) 10.00	
	N-M 0:3316	-18.5 -18.5 0.25 (1) 10.00	
	M-L 0:4132	-18.5 -18.5 0.31 (1) 10.00	
	L-K 0:4132	-18.5 -18.5 0.31 (1) 10.00	
	K-J 0:7680	-18.5 -18.5 0.61 (1) 10.00	
	J-R 0:0	-18.5 -18.5 0.26 (1) 10.00	
	R-I 0:0	-18.5 -18.5 0.26 (1) 10.00	

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
J	31-7-8	-5962	-5962	---	---	FRONT	VERT	TOTAL	---	C1
R	33-8-4	-684	-684	---	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2010, NBCO 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBCO 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/899 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/899 (0.19")

CSI: TC=0.88/1.00 (D-E:1), BC=0.61/1.00 (J-K:1),
WB=0.86/1.00 (G-K:1), SSI=0.17/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618	354
	1687	788
	1987	1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.88 (H) (INPUT = 0.90)
JSI METAL= 0.87 (J) (INPUT = 1.00)

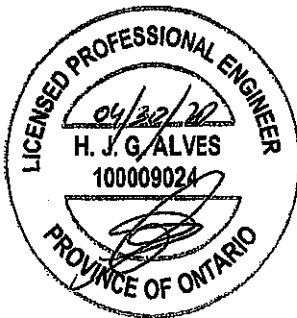

Structural component only
DWG# T-2008058 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408317	T54	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			


Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:50:38 2020 Page 2

ID:DMCubINVR6TstFoe31v8l_zns1l-bX8072l44nbklvQd7pV16pVKGb9vD8jSXFkeqSzLZV1

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	5.0	6.0	2.00	2.75
C	TMWW-l	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	6.0	2.25	2.00
E	TMWW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.25	2.00
G	TMWW-l	MT20	5.0	6.0	2.50	2.00
H	TMWW-l	MT20	6.0	9.0	2.75	4.50
I	BMV1-l	MT20	6.0	9.0	Edge	0.50
J	BMWW-l	MT20	8.0	9.0		
K	BMWW-l	MT20	5.0	6.0	2.50	2.75
L	BS-l	MT20	5.0	6.0		
M	BMWW-l	MT20	5.0	6.0		
N	BS-l	MT20	5.0	6.0		
O	BMWW-l	MT20	5.0	6.0		
P	BMWW-l	MT20	5.0	6.0		
Q	BMV1-p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

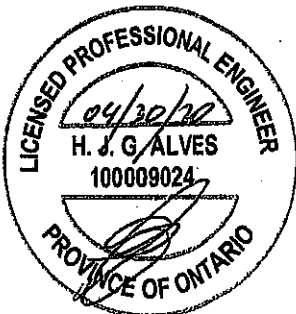

Structural component only
DWG# T-2008058 2/2

JOB NAME 408317	TRUSS NAME T55	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:50:37 2020 Page 1
 10:DMCubINVR6TsFos31v8l_zns11-3jOCQnir5jw2_pgOOGf02rD?Xeyd4blvTBCuzLZV0
 35-1-0 36-4-8 1-3-8
 Scale = 1:87.5

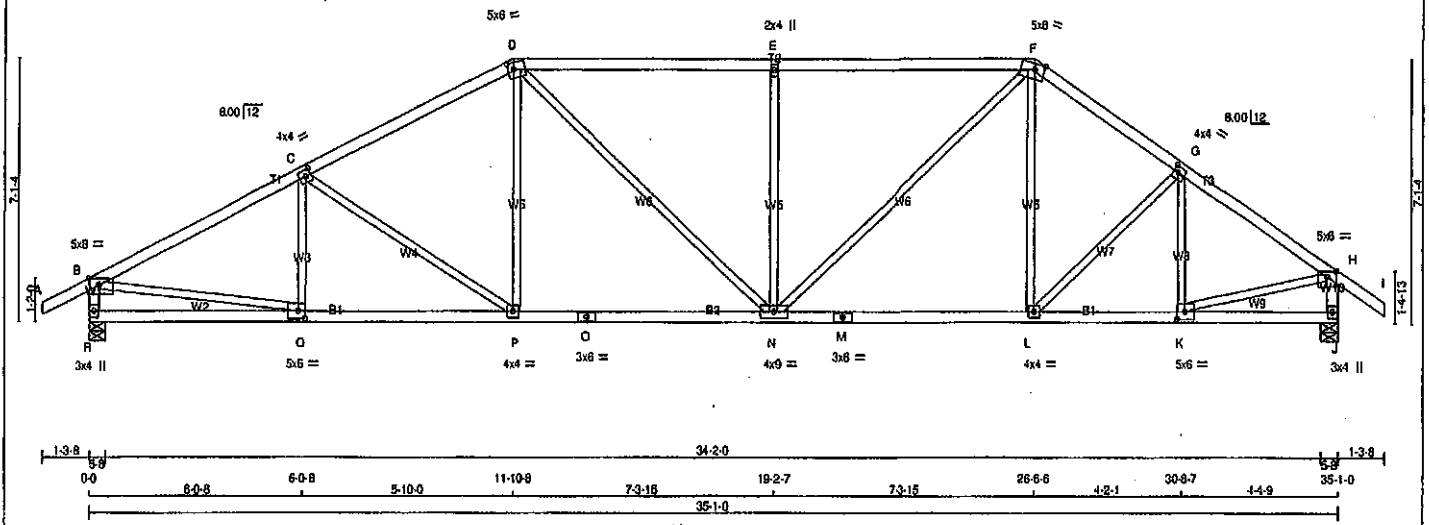

TOTAL WEIGHT = 145 lb
 (M/F)

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
 EXCEPT
 DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0	8.0 Edge 3.50
C	TMVW-l	MT20	4.0	4.0 2.00 1.75
D	TTVW-m	MT20	5.0	8.0 2.25 2.00
E	TMVW-w	MT20	2.0	4.0
F	TTVW-m	MT20	5.0	8.0 2.00 3.25
G	TMVW-l	MT20	4.0	4.0 2.00 1.50
H	TMVW-p	MT20	5.0	8.0 1.75 3.00
J	BMVl+p	MT20	3.0	4.0
K	BMVW-l	MT20	5.0	6.0 2.50 2.75
L	BMVW-l	MT20	4.0	4.0
M	BS-1	MT20	3.0	6.0
N	BMVWVW-l	MT20	4.0	9.0
O	BS-1	MT20	3.0	6.0
P	BMVW-l	MT20	4.0	4.0
Q	BMVW-l	MT20	5.0	6.0 2.50 2.25
R	BMVl+p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED				MAXIMUM FACTORED		INPUT	
GROSS REACTION				GROSS REACTION		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
R	2059	0	2059	0	0	5-8	5-8
J	2060	0	2060	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST CASE MAX/MIN COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1453	987/0	0/0	0/0	0/0	485/0	0/0
J	1454	988/0	0/0	0/0	0/0	487/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.34 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO			
A-B	0/28	-91.8	-91.8 0.12 (1)	10.00	C-C	-258/8	0.07 (1)
B-C	-2880/0	-91.8	-91.8 0.58 (1)	3.58	C-P	-433/0	0.42 (1)
C-D	-2533/0	-91.8	-91.8 0.52 (1)	3.84	P-D	0/363	0.08 (1)
D-E	-2588/0	-91.8	-91.8 0.80 (1)	3.34	D-N	0/440	0.10 (1)
E-F	-2585/0	-91.8	-91.8 0.80 (1)	3.34	N-E	-928/0	0.72 (1)
F-G	-2250/0	-91.8	-91.8 0.27 (1)	4.33	N-F	0/977	0.22 (1)
G-H	-2282/0	-91.8	-91.8 0.27 (1)	4.32	L-F	0/169	0.05 (4)
H-I	0/35	-91.8	-91.8 0.12 (1)	10.00	L-G	-74/0	0.04 (1)
R-B	-2009/0	0.0	0.0 0.20 (1)	5.95	K-G	-401/0	0.11 (1)
J-H	-2021/0	0.0	0.0 0.21 (1)	5.94	B-Q	0/2627	0.59 (1)
					K-H	0/1959	0.44 (1)
R-Q	0/0	-18.5	-18.5 0.14 (4)	10.00			
Q-P	0/2600	-18.5	-18.5 0.51 (1)	10.00			
P-O	0/2244	-18.5	-18.5 0.46 (1)	10.00			
O-N	0/2244	-18.5	-18.5 0.46 (1)	10.00			
N-M	0/1850	-18.5	-18.5 0.40 (1)	10.00			
M-L	0/1850	-18.5	-18.5 0.40 (1)	10.00			
L-K	0/1902	-18.5	-18.5 0.39 (1)	10.00			
K-J	0/0	-18.5	-18.5 0.08 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSI: TC=0.80/1.00 (D-E:1), BC=0.51/1.00 (P-Q:1), WB=0.72/1.00 (E-N:1), SS=0.33/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1867 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (H) (INPUT = 0.90)
 JSI METAL = 0.70 (C) (INPUT = 1.00)

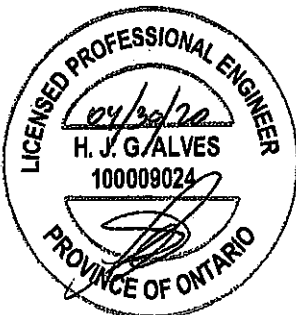


Structural component only
 DWG# T-2008059

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	ORWG NO.
408317	T56	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:50:39 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-06p8d4lyNizJ9M8Cop2kkR7C0e8dQTpuDDYHnzLZV

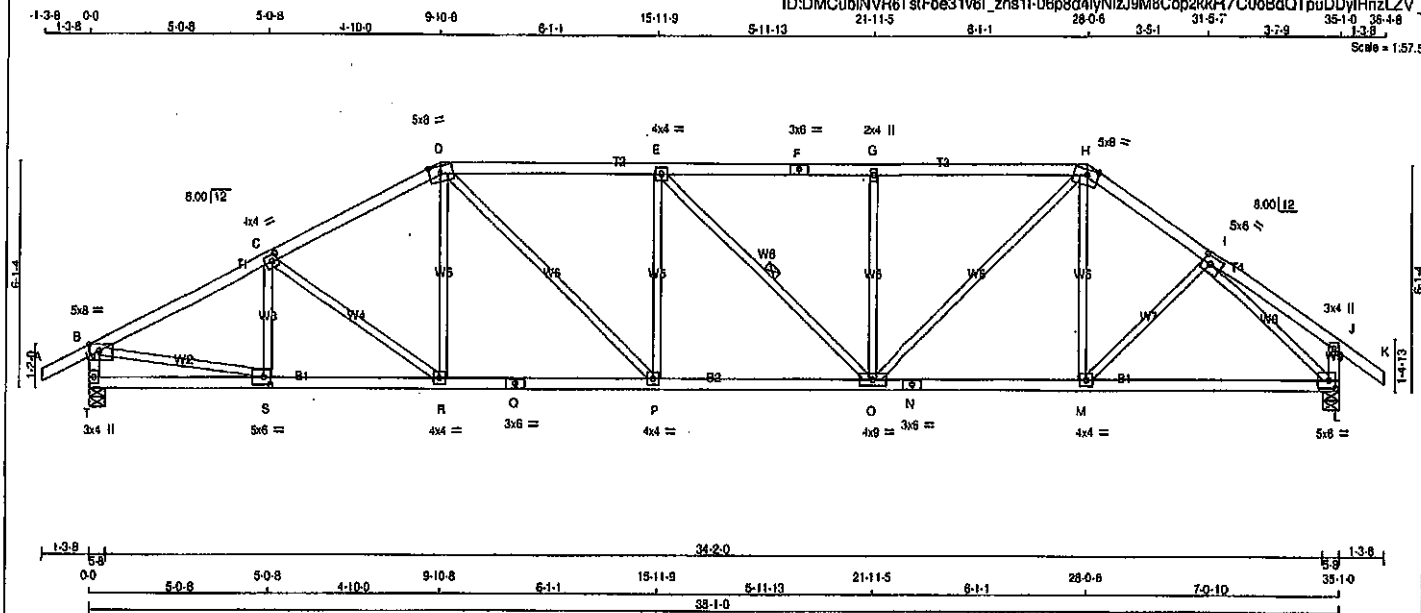

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - K	2x4	DRY	No.2	SPF
T - B	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
T - Q	2x4	DRY	No.2	SPF
Q - N	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)	PLATES	W	LEN	Y	X
JT TYPE					
B	TMVW-p	MT20	5.0	8.0	Edge 3.50
C	TMWW-l	MT20	4.0	4.0	2.00 1.75
D	TTWW-m	MT20	5.0	8.0	2.25 3.75
E	TMWW-l	MT20	4.0	4.0	
F	TS-l	MT20	3.0	6.0	
G	TMW-w	MT20	2.0	4.0	
H	TTWW-m	MT20	5.0	8.0	1.75 3.50
I	TMWW-l	MT20	5.0	8.0	2.50 2.50
J	TMV-p	MT20	3.0	4.0	
L	BMVW-l	MT20	5.0	8.0	2.50 2.25
M, P, R					
M	BMWW-l	MT20	4.0	4.0	
N	BS-l	MT20	3.0	8.0	
O	BMWWW-l	MT20	4.0	9.0	
Q	BS-l	MT20	3.0	8.0	
S	BMWW-l	MT20	5.0	6.0	2.50 2.00
T	BMV-l	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	HORZ	UPLIFT
T	2059	0	0	5-8
L	2060	0	0	5-8

UNFACTORED REACTIONS	1ST LCASE	MAX/MIN COMPONENT REACTIONS	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM.LIVE
T	1453	967 / 0	0 / 0	0 / 0
L	1454	968 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.39 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LOI MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	S-C	-348 / 0	0.08 (1)
B-C	-2828 / 0	-91.8	-91.8 0.54 (1)	3.65	C-R	-218 / 0	0.14 (1)
C-D	-2874 / 0	-91.8	-91.8 0.51 (1)	3.75	R-D	0 / 231	0.05 (1)
D-E	-2958 / 0	-91.8	-91.8 0.72 (1)	3.39	O-P	0 / 808	0.18 (1)
E-F	-2795 / 0	-91.8	-91.8 0.68 (1)	3.50	P-E	-444 / 0	0.28 (1)
F-G	-2795 / 0	-91.8	-91.8 0.68 (1)	3.50	E-O	-228 / 0	0.11 (1)
G-H	-2795 / 0	-91.8	-91.8 0.68 (1)	3.50	O-G	-599 / 0	0.35 (1)
H-I	-2299 / 0	-91.8	-91.8 0.23 (1)	4.32	C-H	0 / 1243	0.28 (1)
I-J	0 / 18	-91.8	-91.8 0.16 (1)	10.00	M-H	0 / 95	0.03 (4)
J-K	0 / 35	-91.8	-91.8 0.12 (1)	10.00	M-I	0 / 134	0.03 (4)
T-B	-2015 / 0	0.0	0.0 0.20 (1)	5.95	B-S	0 / 2586	0.58 (1)
L-J	-255 / 0	0.0	0.0 0.03 (1)	7.81	I-L	-2508 / 0	0.98 (1)
T-S	0 / 0	-18.5	-18.5 0.10 (4)	10.00			
S-R	0 / 2549	-18.5	-18.5 0.48 (1)	10.00			
R-Q	0 / 2374	-18.5	-18.5 0.45 (1)	10.00			
Q-P	0 / 2374	-18.5	-18.5 0.45 (1)	10.00			
P-O	0 / 2958	-18.5	-18.5 0.64 (1)	10.00			
O-N	0 / 1995	-18.5	-18.5 0.42 (1)	10.00			
N-M	0 / 1995	-18.5	-18.5 0.42 (1)	10.00			
M-L	0 / 1797	-18.5	-18.5 0.40 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.18')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.31')

CSI: TO=0.72/1.00 (D-E:1), BC=0.54/1.00 (O-P:1), WB=0.98/1.00 (I-L:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (L) (INPUT = 0.90)
JSI METAL= 0.74 (C) (INPUT = 1.00)



Structural component only
DWG# T-2008060

JOB NAME 408317	TRUSS NAME T57	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:58:40 2020 Page 1					
ID:DMCubINVR6TstF0a31v6l_zns11-UINXqQia805AnWjOMWazHfgO_CWu9zF2StiroDzLZUz					
Scale = 1:57.5					

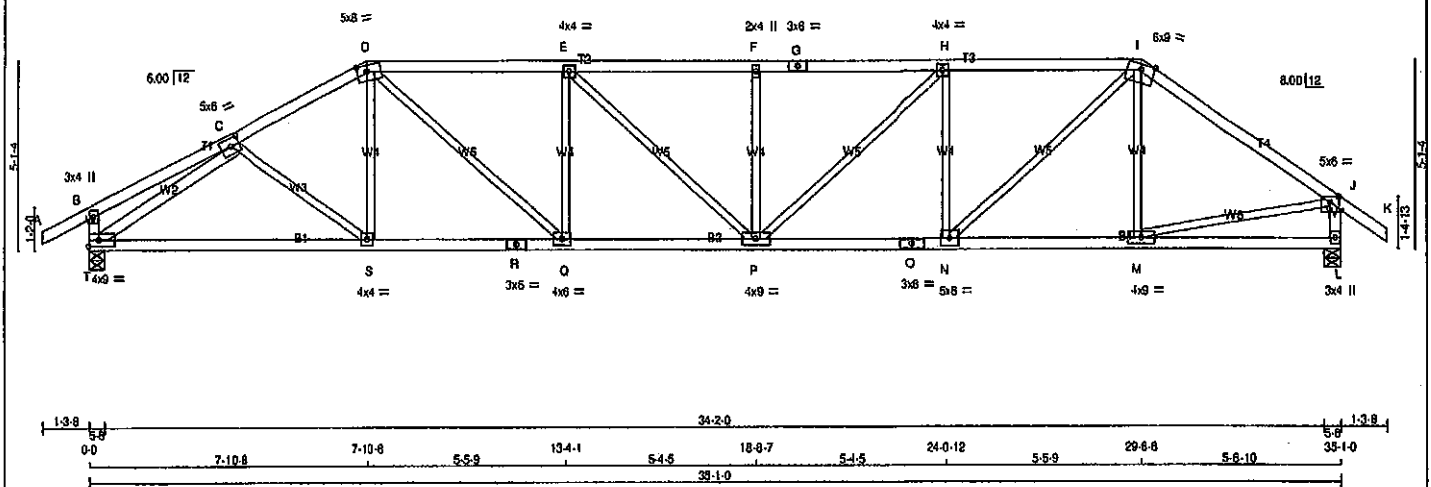

LUMBER		
N. L. G. A. RULES		
CHORDS	SIZE	LUMBER
A - D	2x4	DRY No.2
D - G	2x4	DRY No.2
G - I	2x4	DRY No.2
I - K	2x4	DRY No.2
T - B	2x4	DRY No.2
L - J	2x4	DRY No.2
T - R	2x4	DRY No.2
R - O	2x4	DRY No.2
O - L	2x4	DRY No.2
ALL WEBS	2x3	DRY No.2
EXCEPT		
T - C	2x4	DRY No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMV-p	MT20	3.0	4.0	
C TMWW-1	MT20	5.0	8.0	2.50 2.75
D TTWW-m	MT20	5.0	8.0	2.00 3.25
E TMWW-1	MT20	4.0	4.0	
F TMW-w	MT20	2.0	4.0	
G TS-1	MT20	3.0	8.0	
H TMWW-1	MT20	4.0	4.0	
I TTWW-m	MT20	6.0	9.0	Edge
J TMVW-p	MT20	5.0	8.0	1.75 3.00
L BMV-1-p	MT20	3.0	4.0	
M BMWW-1	MT20	4.0	9.0	
N BMWW-1	MT20	5.0	8.0	
O BS-1	MT20	3.0	8.0	
P BMWW-1	MT20	4.0	9.0	
Q BMWW-1	MT20	4.0	6.0	
R BS-1	MT20	3.0	6.0	
S BMWW-1	MT20	4.0	4.0	
T BMVW-1	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	UP/LIFT
T	2059	0	2059	0
L	2060	0	2080	0

5-8 5-8

5-8 5-8

UNFACTURED REACTIONS

	1ST CASE COMBINED	MAX/MIN. COMPONENT REACTIONS SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	1453	967 / 0	0 / 0	0 / 0	0 / 0	483 / 0	0 / 0
L	1454	968 / 0	0 / 0	0 / 0	0 / 0	487 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.16 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED (PLF)	MAX. FACTORED (CSI (LC))	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED (CSI (LC))		
FR-TO					FR-TO				
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	C-S	0 / 92	0.03 (4)	
B-C	0 / 16	-91.8	-91.8	0.20 (1)	10.00	S-D	0 / 117	0.04 (4)	
C-D	-2790 / 0	-91.8	-91.8	0.31 (1)	3.89	D-Q	0 / 1201	0.27 (1)	
D-E	-3383 / 0	-91.8	-91.8	0.65 (1)	3.26	Q-E	-712 / 0	0.27 (1)	
E-F	-3551 / 0	-91.8	-91.8	0.67 (1)	3.16	E-P	0 / 226	0.05 (1)	
F-G	-3551 / 0	-91.8	-91.8	0.67 (1)	3.16	P-F	-454 / 0	0.17 (1)	
G-H	-3551 / 0	-91.8	-91.8	0.67 (1)	3.16	P-H	0 / 607	0.14 (1)	
H-I	-3100 / 0	-91.8	-91.8	0.61 (1)	3.42	N-H	-963 / 0	0.37 (1)	
I-J	-2289 / 0	-91.8	-91.8	0.70 (1)	3.79	N-I	0 / 1601	0.30 (1)	
J-K	0 / 35	-91.8	-91.8	0.12 (1)	10.00	M-I	-247 / 5	0.08 (1)	
T-B	-270 / 0	0.0	0.0	0.03 (1)	7.81	T-C	-2865 / 0	0.82 (1)	
L-J	-2017 / 0	0.0	0.0	0.21 (1)	5.94	M-J	0 / 1936	0.44 (1)	
T-S	0 / 2410	-18.5	-18.5	0.53 (1)	10.00				
S-R	0 / 2480	-18.5	-18.5	0.53 (1)	10.00				
R-Q	0 / 2480	-18.5	-18.5	0.53 (1)	10.00				
Q-P	0 / 3363	-18.5	-18.5	0.60 (1)	10.00				
P-O	0 / 3100	-18.5	-18.5	0.55 (1)	10.00				
O-N	0 / 3100	-18.5	-18.5	0.55 (1)	10.00				
N-M	0 / 1897	-18.5	-18.5	0.38 (1)	10.00				
M-L	0 / 0	-18.5	-18.5	0.14 (4)	10.00				

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF
SPACING = 24.0 IN. C/C	
LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12	
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015	
THIS DESIGN COMPLIES WITH:	
- PART 9 OF CBC 2018, CBC 2012, ABC 2019	
- PART 9 OF CBC 2012 (2019 AMENDMENT)	
- CSA 086-09, CSA 086-14	
- TPIC 2011, TPIC 2014	
(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD	
ALLOWABLE DEFL. (LL) = L/360 (1.17")	
CALCULATED VERT. DEFL. (LL) = L/999 (0.21")	
ALLOWABLE DEFL. (TL) = L/360 (1.17")	
CALCULATED VERT. DEFL. (TL) = L/999 (0.30")	
CSI: TC=0.70/1.00 (I-J), BC=0.60/1.00 (P-Q), WB=0.82/1.00 (C-T), SS=0.23/1.00 (H-I)	
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10	
COMP=1.10 SHEAR=1.10 TENS=1.10	
COMPANION LIVE LOAD FACTOR = 1.00	
AUTOSOLVE RIGHT HEEL ONLY	
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.	
NAIL VALUES	
PLATE GRIP (DRY) SHEAR SECTION	
(PS) (PL)	(PL)
MAX MIN MAX MIN MAX MIN	
MT20 618 354 1687 788 1887 1656	
PLATE PLACEMENT TOL. = 0.260 inches	
PLATE ROTATION TOL. = 5.0 Deg.	
JSI GRIP = 0.90 (J) (INPUT = 0.90)	
JSI METAL = 0.90 (O) (INPUT = 1.00)	




Structural component only
DWG# T-2008061

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408317	T58	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:50:41 2020 Page 1

ID:DMCub\NVR8Ts\Foe31v61_zns11-yVxv2m\DVKD1Pg\lvE5CpsCcXcs7uUdEgXRPKzLZUy

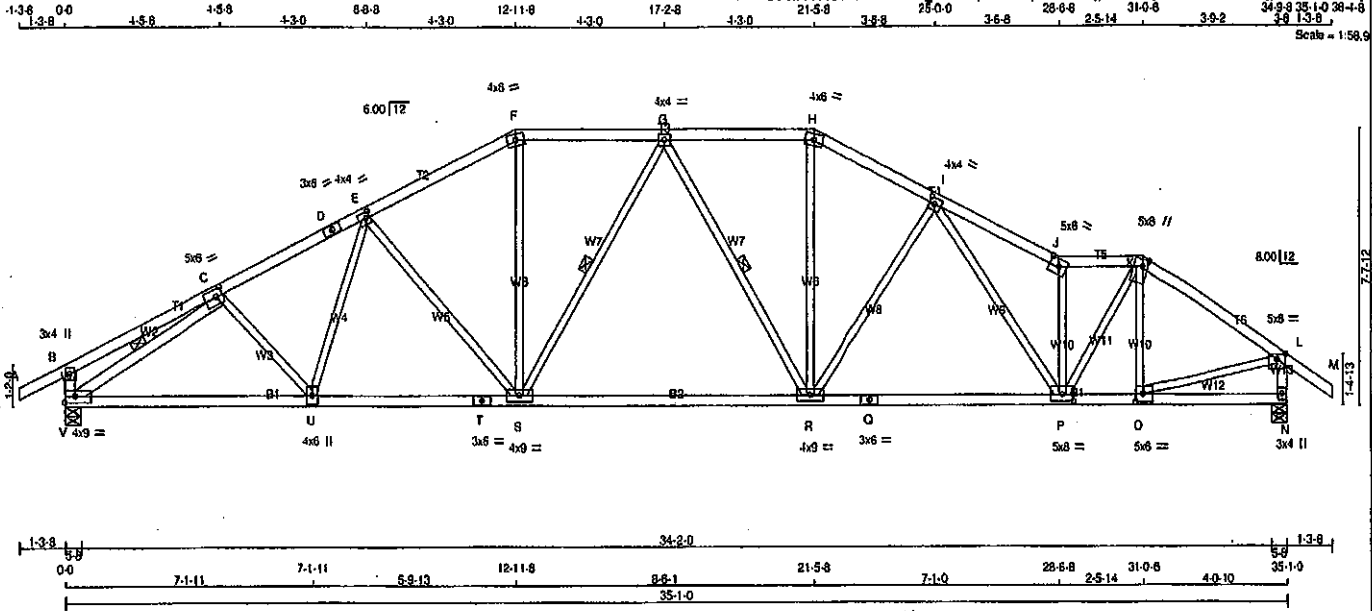

TOTAL WEIGHT = 155 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
J - K	2x4	DRY	No.2	SPF	
K - M	2x4	DRY	No.2	SPF	
M - L	2x4	DRY	No.2	SPF	
L - N	2x4	DRY	No.2	SPF	
N - T	2x4	DRY	No.2	SPF	
T - Q	2x4	DRY	No.2	SPF	
Q - N	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
V - C	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (tabulate in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B TMV-p	MT20			3.0	4.0		
C TMWW-1	MT20			5.0	8.0	2.50	2.25
D TS-1	MT20			3.0	6.0		
E TMWW-1	MT20			4.0	4.0	2.00	1.25
F TTW-m	MT20			4.0	8.0		
G TMWW-1	MT20			4.0	4.0		
H TTW-m	MT20			4.0	6.0		
I TMWW-1	MT20			4.0	4.0	2.00	1.75
J TTW-h	MT20			5.0	6.0	2.50	3.25
K TTWW+m	MT20			5.0	8.0	2.25	1.75
L TMVW-p	MT20			5.0	6.0	1.75	3.00
N BMV1-p	MT20			3.0	4.0		
O BMWW-1	MT20			5.0	6.0	2.50	2.75
P BMWW-1	MT20			5.0	8.0	2.25	4.00
Q BS-1	MT20			3.0	6.0		
R BMWW-1	MT20			4.0	9.0		
S BS-1	MT20			4.0	9.0		
T BS-1	MT20			3.0	8.0		
U BMWW-1	MT20			4.0	6.0		
V BMVW-1	MT20			4.0	9.0		Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
V	2059	0	2059	0	5-8
N	2060	0	2060	0	5-8

UNFACTORED REACTIONS		MAX/MIN COMPONENT REACTIONS			
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
V	1453	987/0	0/0	0/0	0/0
N	1454	988/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, N

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-S, G-R, C-V.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT.	LOAD (PLF)	MAX. CSI (LC)	UNBRAC. LENGTH	MEMB.	FORCE (LBS)
FR-TO						FR-TO	
A-B	0/28	-91.8	-91.8	0.13 (1)	10.00	C-U	0/77
B-C	0/15	-91.8	-91.8	0.23 (1)	10.00	U-E	0/95
C-D	-2780/0	-91.8	-91.8	0.39 (1)	3.78	E-S	-474/0
D-E	-2780/0	-91.8	-91.8	0.39 (1)	3.78	S-F	0/769
E-F	-2429/0	-91.8	-91.8	0.36 (1)	4.04	G-R	-317/0
F-G	-2187/0	-91.8	-91.8	0.37 (1)	4.21	R-H	-222/0
G-H	-2213/0	-91.8	-91.8	0.37 (1)	4.16	H-I	0/806
H-I	-2481/0	-91.8	-91.8	0.30 (1)	4.05	I-P	-563/0
I-J	-3018/0	-91.8	-91.8	0.35 (1)	3.67	P-J	0/378
J-K	-2874/0	-91.8	-91.8	0.20 (1)	4.03	K-L	-1585/0
K-L	-2219/0	-91.8	-91.8	0.39 (1)	4.15	L-M	-2991/0
L-M	0/35	-91.8	-91.8	0.14 (1)	10.00	M-N	-411/0
M-N	-291/0	0.0	0.0	0.03 (1)	7.81	N-O	0/1583
N-O	-2027/0	0.0	0.0	0.23 (1)	5.88	O-L	0/1904
V-U	0/2454	-18.5	-18.5	0.57 (1)	10.00		
U-T	0/2460	-18.5	-18.5	0.55 (1)	10.00		
T-S	0/2480	-18.5	-18.5	0.55 (1)	10.00		
S-R	0/2322	-18.5	-18.5	0.58 (1)	10.00		
R-Q	0/2510	-18.5	-18.5	0.81 (1)	10.00		
Q-P	0/2510	-18.5	-18.5	0.81 (1)	10.00		
P-O	0/1832	-18.5	-18.5	0.36 (1)	10.00		
O-N	0/0	-18.5	-18.5	0.08 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.31")

CSI: TC=0.39/1.00 (C-E:1), BC=0.61/1.00 (P-R:1), WB=0.50/1.00 (C-V:1), SS=0.21/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (K) (INPUT = 0.90)
JSI METAL = 0.75 (T) (INPUT = 1.00)



Structural component only
DWG# T-2008062

JOB NAME 408317	TRUSS NAME T59	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:43 2020 Page 1	
ID:DMCubINVR6TsIFoe31v6t, zns1t-ut3ITSITRtTeeSz1f7guHlu8QTSMinU8rwWPYzLZUw				229-14	
Scale = 1:56.5					

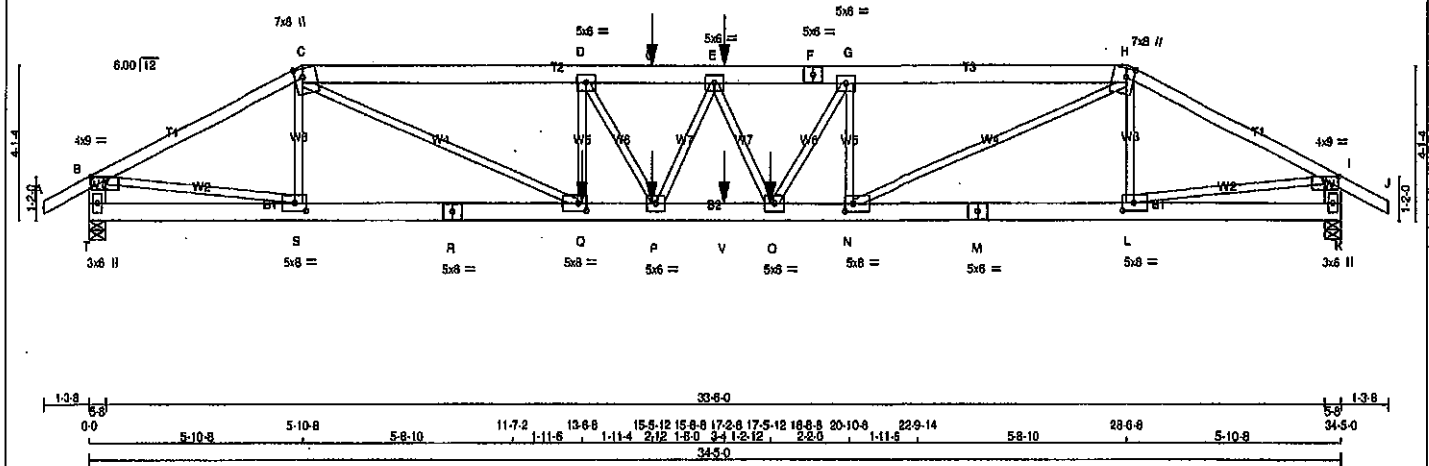

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. SPF A - C 2x4 DRY No.2 C - F 2x6 DRY No.2 F - H 2x6 DRY No.2 H - J 2x4 DRY No.2 T - B 2x6 DRY No.2 K - I 2x6 DRY No.2 R - M 2x6 DRY No.2 T - M 2x6 DRY No.2 M - K 2x6 DRY No.2 ALL WEBS 2x3 DRY No.2 EXCEPT DRY: SEASONED LUMBER. DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS: CHORDS & ROWS SURFACE SPACING (IN) LOAD (PLF) TOP CHORDS : (0.122"x3") SPIRAL NAILS A - C 1 12 TOP H - J 1 12 TOP C - F 2 12 SIDE(0.0) F - H 2 12 TOP T - B 2 12 TOP K - I 2 12 TOP BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS T - R 2 12 TOP R - M 2 12 TOP M - K 2 12 TOP WEBS : (0.122"x3") SPIRAL NAILS Q - D 1 6 SIDE(237.3) 2x3 1 6 NAILS TO BE DRIVEN FROM ONE SIDE ONLY. GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS. TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.8 PSF DL = 8.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2018, OBC 2012, ABC 2019 - PART 9 OF OBC 2012 (2019 AMENDMENT) - CSA 088-09, CSA 086-14 - TPIC 2011, TPIC 2014 (55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/380 (1.15") CALCULATED VERT. DEFL.(LL) = 1/899 (0.34") ALLOWABLE DEFL.(TL)= L/380 (1.15") CALCULATED VERT. DEFL.(TL) = 1/671 (0.62") CSI: TC=0.64/1.00 (B-C:1), BC=0.93/1.00 (O-P:1), WB=0.84/1.00 (Q-D:1), SS=0.13/1.00 (C-D:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00 COMPANION LIVE LOAD FACTOR = 1.00 AUTOSOLVE HEELS OFF TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 788 1997 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.88 (N) (INPUT = 0.90) JSI METAL= 0.80 (R) (INPUT = 1.00)				FACTORED CONCENTRATED LOADS (LBS) JT LOC. LC1 MAX+ FACE DIR. TYPE HEEL CONN. E 17-5-12 -110 -110 --- BACK VERT TOTAL --- C1 O 18-8-8 -2098 -2098 --- BACK VERT TOTAL --- C1 P 15-5-12 -26 -26 --- BACK VERT TOTAL --- C1 Q 13-6-8 -1811 -1811 --- BACK VERT TOTAL --- C1 U 15-5-12 -110 -110 --- BACK VERT TOTAL --- C1 V 17-5-12 -26 -26 --- BACK VERT TOTAL --- C1 CONNECTION REQUIREMENTS 11 C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.			
--	--	--	--	--	--	--	--	---	--	--	--



Structural component only
DWG# T-2008063 1/2


JOB NAME 408317	TRUSS NAME T59	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamrack Pool Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Thu Apr 30 10:50:43 2020 Page 2
ID:DMCubINV86TstFoe31v6I zns1I-uj3ITSIRxT9zSz117guHlu8QTSMinU8rwWPYzLZUw

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	4.0	9.0	1.00	4.75
C	TTWW+m	MT20	7.0	8.0	2.75	2.50
D, E, G						
D	TMWW-t	MT20	5.0	8.0		
F	TS-t	MT20	5.0	6.0		
H	TTWW+m	MT20	7.0	8.0	2.75	2.50
I	TMWW-p	MT20	4.0	9.0	1.00	4.75
K	BMV1-p	MT20	3.0	6.0		
L	BMWW-t	MT20	5.0	8.0	2.50	3.75
M	BS-t	MT20	5.0	8.0		
N	BMWW-t	MT20	5.0	8.0	2.50	2.75
O	BMWW-t	MT20	5.0	8.0		
P	BMWW-t	MT20	5.0	6.0		
Q	BMWW-t	MT20	5.0	8.0	2.50	2.75
R	BS-t	MT20	5.0	6.0		
S	BMWW-t	MT20	5.0	8.0	2.50	3.75
T	BMV1-p	MT20	3.0	6.0		

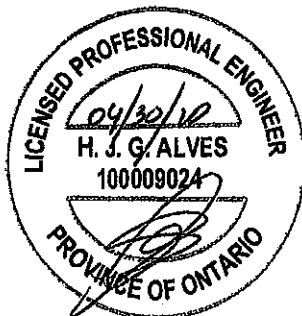


Structural component only
DWG# T-2008063

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408317	T60X	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:50:44 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns11-M4d1gom5CFbcG71AbMeVrVq0bptP5jzdmVg3x_zLZUv

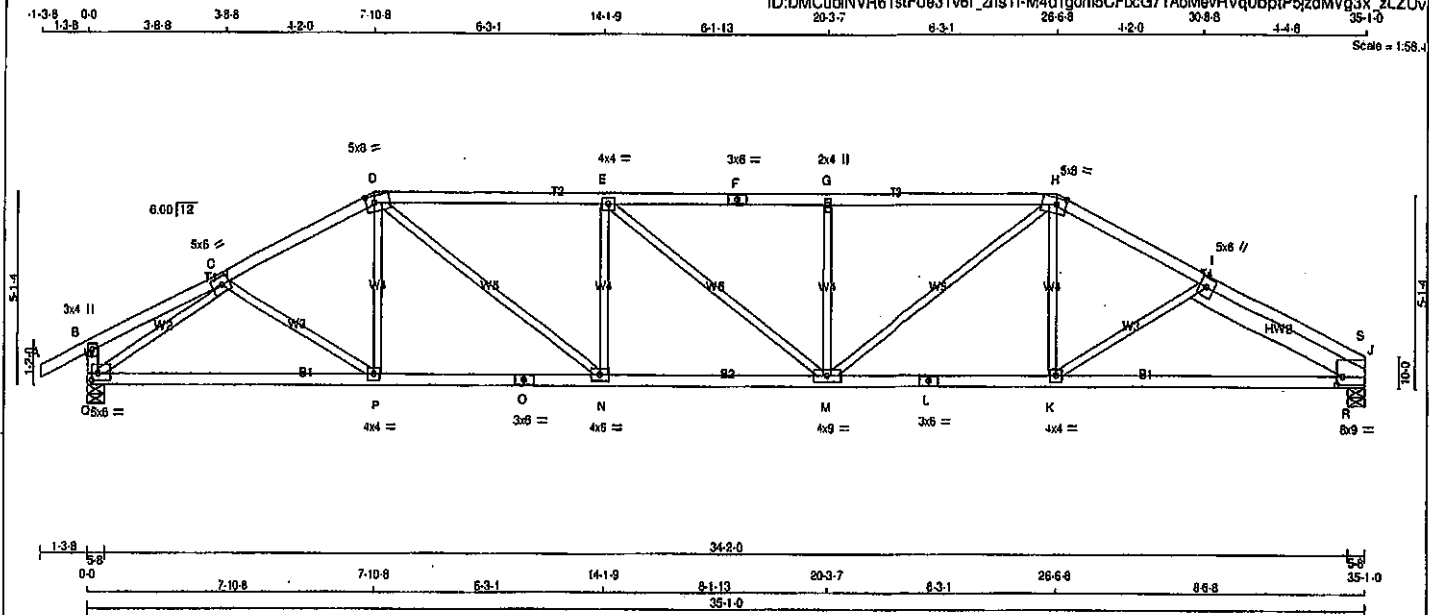

TOTAL WEIGHT = 139 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2	
E - F	2x4	DRY	No.2	
G - H	2x4	DRY	No.2	
H - J	2x4	DRY	No.2	
O - B	2x4	DRY	No.2	
O - O	2x4	DRY	No.2	
O - L	2x4	DRY	No.2	
L - J	2x4	DRY	No.2	

REINFORCING MEMBERS	HW2	2x8	DRY	No.2
ALL WEBS	2x3	DRY	No.2	
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	5.0	8.0	2.50	2.75
D	TTWW-m	MT20	5.0	8.0	2.25	2.75
E	TMWW-t	MT20	4.0	4.0		
F	TS-t	MT20	3.0	8.0		
G	TMW-w	MT20	2.0	4.0		
H	TTWW-m	MT20	5.0	8.0	2.25	3.25
I	TMWW-t	MT20	5.0	8.0		
J	TMBMW-t	MT20	8.0	8.0	2.50	2.00
K	BMWW-t	MT20	4.0	4.0		
L	BS-t	MT20	3.0	6.0		
M	BMWWW-t	MT20	4.0	9.0		
N	BMWW-t	MT20	4.0	8.0		
O	BS-t	MT20	3.0	6.0		
P	BMWW-t	MT20	4.0	4.0		
Q	BMWW-t	MT20	5.0	8.0	2.25	2.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
	VERT	HORZ	DOWN	HORZ
JT	1934	0	1934	0
J	1934	0	1934	0
Q	2059	0	2059	0

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN	COMPONENT REACTIONS	PERM	LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW					
J	1368	898 / 0	0 / 0	0 / 0	0 / 0	470.0	0 / 0
Q	1453	987 / 0	0 / 0	0 / 0	0 / 0	488.0	0 / 0

BEARING MATERIAL TO BE SPFF NO.2 OR BETTER AT JOINT(S) J, Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.02 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	FORCE	VERT. LOAD	LC1	MAX	UNBRAC	LENGTH	FR-TO	WEBS	MEMB.	MAX. FACTORED	FORCE	MAX
		(LBS)	(PLF)	(PLF)	(LC)	(LC)	(LC)	(LC)				(LBS)	(LBS)	(LC)
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	C-P	0 / 130	0.04 (4)						
B-C	0 / 17	-91.8	-91.8	0.19 (1)	10.00	P-D	0 / 116	0.04 (4)						
C-D	-2789 / 0	-91.8	-91.8	0.32 (1)	3.89	D-N	0 / 1246	0.28 (1)						
D-E	-3469 / 0	-91.8	-91.8	0.85 (1)	3.05	N-E	-855 / 0	0.25 (1)						
E-F	-3515 / 0	-91.8	-91.8	0.85 (1)	3.02	E-M	0 / 59	0.01 (1)						
F-G	-3515 / 0	-91.8	-91.8	0.85 (1)	3.02	M-G	-617 / 0	0.24 (1)						
G-H	-3515 / 0	-91.8	-91.8	0.85 (1)	3.03	M-H	0 / 1128	0.25 (1)						
H-I	-2942 / 0	-91.8	-91.8	0.33 (1)	3.80	K-H	0 / 231	0.06 (4)						
I-S	-1483 / 0	-91.8	-91.8	0.23 (1)	5.13	K-I	-184 / 0	0.07 (1)						
S-J	-2458 / 0	-91.8	-91.8	0.16 (1)	4.25	Q-C	-2942 / 0	0.97 (1)						
Q-B	-252 / 0	0.0	0.0	0.03 (1)	7.81	R-S	0 / 1217	0.00 (1)						
						R-I	-1727 / 0	0.34 (1)						
Q-P	0 / 2368	-18.5	-18.5	0.52 (1)	10.00									
P-O	0 / 2481	-18.5	-18.5	0.53 (1)	10.00									
O-N	0 / 2491	-18.5	-18.5	0.53 (1)	10.00									
N-M	0 / 3469	-18.5	-18.5	0.83 (1)	10.00									
M-L	0 / 2821	-18.5	-18.5	0.54 (1)	10.00									
L-K	0 / 2821	-18.5	-18.5	0.54 (1)	10.00									
K-R	0 / 2754	-18.5	-18.5	0.56 (1)	10.00									
R-J	0 / 1333	-18.5	-18.5	0.35 (4)	10.00									

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.40")

CSK: TC=0.85/1.00 (G-H:1), BC=0.83/1.00 (M-N:1),
WB=0.97/1.00 (C-Q:1), SS=0.28/1.00 (J-R:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)
MAX	MIN	MAX
MT20	618	354
	1887	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (4) (INPUT = 0.90)
JSI METAL = 0.81 (L) (INPUT = 1.00)




Structural component only
DWG# T-2008064

JOB NAME 408317	TRUSS NAME T61X	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 8 Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:50:45 2020 Page 1
ID:DMCubINVR6TslFoe31v6L_zns1l-qOBQu7mjzYtTuHcM8398_jNBBD88qGHnb9PcTqZLZUu

1-3.8 0.0 5-0.8 5-0.8 1-10.0 9-10.8 7-4.0 17-2.8 7-4.0 24-6.8 1-10.0 29-4.8 5-8.8 35-1.0
Scale = 1:56.5

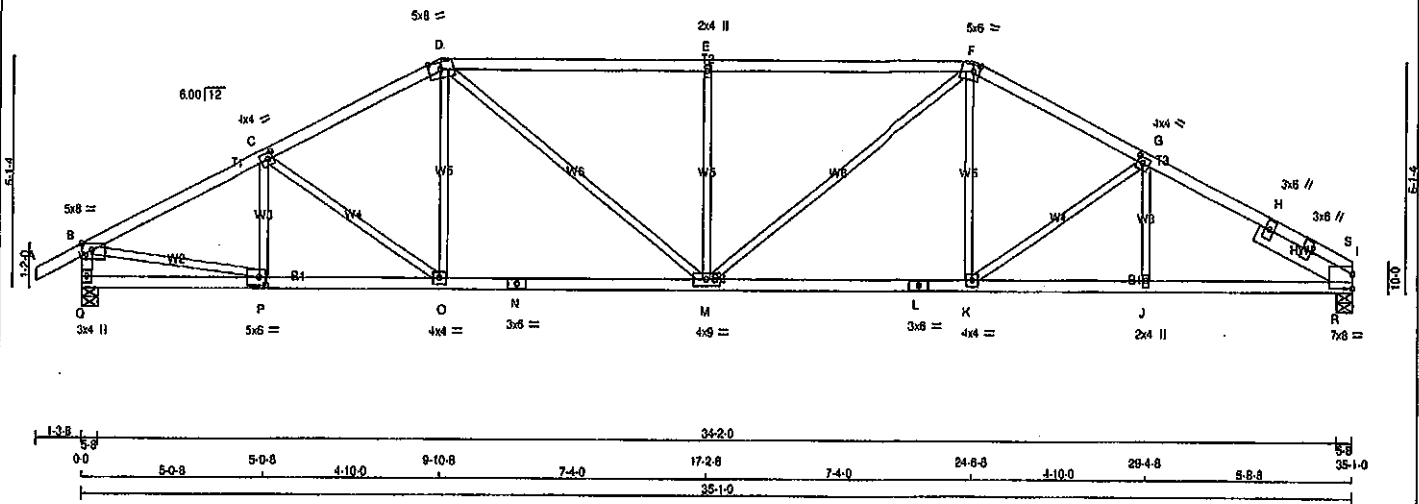

TOTAL WEIGHT = 137 lb (M/F)

LUMBER				N. L. G. A. RULES	
CHORDS	SIZE	LUMBER	DESCR.	SPF	SPF
A - D	2x4	DRY	No.2	SPF	SPF
D - F	2x4	DRY	No.2	SPF	SPF
F - I	2x4	DRY	No.2	SPF	SPF
Q - B	2x4	DRY	No.2	SPF	SPF
Q - N	2x4	DRY	No.2	SPF	SPF
N - L	2x4	DRY	No.2	SPF	SPF
L - I	2x4	DRY	No.2	SPF	SPF

REINFORCING MEMBERS				LUMBER	
CHORDS	SIZE	LUMBER	DESCR.	SPF	SPF
HW2	2x6	DRY	No.2	SPF	SPF

ALL WEBS EXCEPT				LUMBER	
CHORDS	SIZE	LUMBER	DESCR.	SPF	SPF
HW2	2x6	DRY	No.2	SPF	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TMVW-t	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	8.0	2.25	3.75
E	TMVW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	8.0	2.25	2.00
G	TMVW-t	MT20	4.0	4.0	2.00	1.75
I	TMBMR-t	MT20	7.0	8.0	4.50	
I	RT-t	MT20	3.0	8.0		
J	RT-t	MT20	3.0	8.0		
J	BMVW-w	MT20	2.0	4.0		
K	BMVW-t	MT20	4.0	4.0		
L	BS-t	MT20	3.0	6.0		
M	BMVW-t	MT20	4.0	4.0		
N	BS-t	MT20	3.0	6.0		
O	BMVW-t	MT20	4.0	4.0		
P	BMVW-t	MT20	5.0	6.0	2.50	2.00
Q	BMV-t	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG	BRG
I	1934	0	1934	0	0	5-8	5-8		
Q	2059	0	2059	0	0	5-8	5-8		

UNFACTORED REACTIONS

1ST CASE		MAX/MIN. COMPONENT REACTIONS		LIVE		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW
I	1388	888 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0	470 / 0	0 / 0	0 / 0	0 / 0
Q	1453	987 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	488 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		FACTORED		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	LC1 MAX (LC)	LC1 MAX (LC)	MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	LC1 MAX (LC)	LC1 MAX (LC)
FR-TO						FR-TO					
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	P-C	-351 / 0	0.08 (1)			
B-C	-2827 / 0	-91.8	-91.8	0.39 (1)	3.81	Q-D	-213 / 0	0.13 (1)			
C-D	-2878 / 0	-91.8	-91.8	0.37 (1)	3.82	O-D	0 / 244	0.08 (4)			
D-E	-3031 / 0	-91.8	-91.8	0.88 (1)	3.03	D-M	0 / 835	0.19 (1)			
E-F	-3031 / 0	-91.8	-91.8	0.88 (1)	3.03	M-E	-828 / 0	0.48 (1)			
F-G	-2763 / 0	-91.8	-91.8	0.45 (1)	3.77	M-F	0 / 713	0.18 (1)			
G-H	-2210 / 0	-91.8	-91.8	0.53 (1)	4.02	K-F	0 / 321	0.07 (1)			
H-S	-2210 / 0	-91.8	-91.8	0.53 (1)	4.02	K-G	-315 / 0	0.20 (1)			
S-I	-2714 / 0	-91.8	-91.8	0.17 (1)	4.09	J-G	0 / 771	0.02 (4)			
Q-B	-2014 / 0	0.0	0.0	0.20 (1)	5.95	B-P	0 / 2585	0.58 (1)			
						R-S	0 / 1839	0.00 (1)			
						R-H	-1903 / 0	0.18 (1)			
Q-P	0 / 0	-18.5	-18.5	0.10 (4)	10.00						
P-O	0 / 2548	-18.5	-18.5	0.50 (1)	10.00						
O-N	0 / 2377	-18.5	-18.5	0.47 (1)	10.00						
N-M	0 / 2377	-18.5	-18.5	0.47 (1)	10.00						
M-L	0 / 2472	-18.5	-18.5	0.51 (1)	10.00						
L-K	0 / 2472	-18.5	-18.5	0.51 (1)	10.00						
K-J	0 / 2727	-18.5	-18.5	0.55 (1)	10.00						
J-R	0 / 2727	-18.5	-18.5	0.73 (1)	10.00						
R-I	0 / 1301	-18.5	-18.5	0.50 (1)	10.00						

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 8.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN PLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $\frac{1}{360}$ (1.17")
CALCULATED VERT. DEFL.(LL) = $\frac{1}{999}$ (0.16")
ALLOWABLE DEFL.(TL) = $\frac{1}{360}$ (1.17")
CALCULATED VERT. DEFL.(TL) = $\frac{1}{989}$ (0.35")

CSI: TC=0.89/1.00 (D-E:1), BC=0.79/1.00 (J-R:1),
WB=0.58/1.00 (B-P:1), SS=0.37/1.00 (I-R:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (F) (INPUT = 0.90)
JSI METAL = 0.98 (I) (INPUT = 1.00)




Structural component only
DWG# T-2008065

JOB NAME 408317	TRUSS NAME T62X	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:46 2020 Page 1

ID:DMCubINVR6TstFos31v8l_zns1-JSlo5TnLsrKVRByingNWwvQNdY4ZINwq9A0izLZU

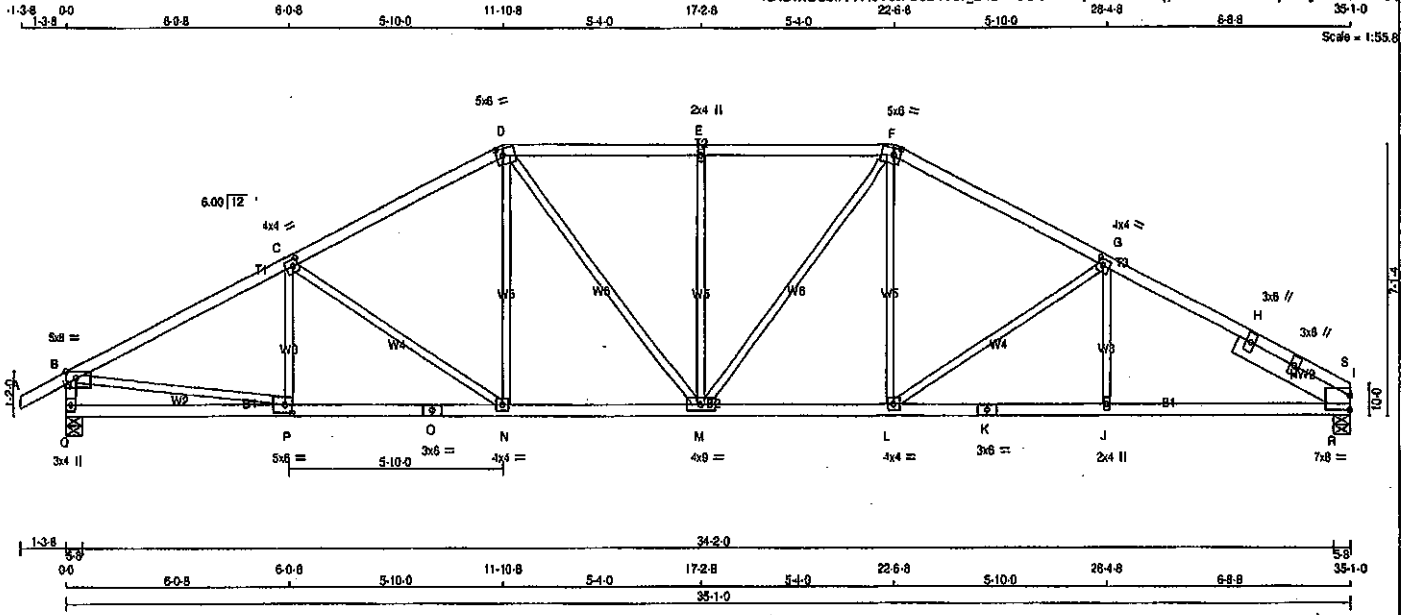

TOTAL WEIGHT = 143 lb (M/F)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4 DRY	No.2	SPF		
D - F	2x4 DRY	No.2	SPF		
F - I	2x4 DRY	No.2	SPF		
Q - B	2x4 DRY	No.2	SPF		
Q - O	2x4 DRY	No.2	SPF		
O - K	2x4 DRY	No.2	SPF		
K - I	2x4 DRY	No.2	SPF		

REINFORCING MEMBERS	SIZE	LUMBER	DESCR.
HW2	2x6 DRY	No.2	SPF

ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TMVW-l	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	8.0	2.25	2.00
E	TMVW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	8.0	2.25	2.00
G	TMVW-l	MT20	4.0	4.0	2.00	1.75
I	TMBMR-l	MT20	7.0	8.0	4.50	
J	RT-l	MT20	3.0	6.0		
K	RT-l	MT20	3.0	6.0		
L	BMVW-w	MT20	2.0	4.0		
M	BMVW-w	MT20	4.0	4.0		
N	BMVW-l	MT20	4.0	4.0		
O	BS-l	MT20	3.0	6.0		
P	BMVW-l	MT20	5.0	6.0	2.50	2.25
Q	BMVW-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
I	1934	0	1934	0
Q	2059	0	2059	0

UNFACTORED REACTIONS

	1ST LCASE	MAX/MIN	COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
I	1368	898 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0	
Q	1453	987 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	P-C	-253 / 13	0.07 (1)	
B-C	-2881 / 0	-91.8	-91.8 0.58 (1)	C-N	-437 / 0	0.42 (1)	
C-D	-2530 / 0	-91.8	-91.8 0.52 (1)	D-M	0 / 349	0.08 (1)	
D-E	-2538 / 0	-91.8	-91.8 0.42 (1)	E-M	0 / 481	0.11 (1)	
E-F	-2538 / 0	-91.8	-91.8 0.42 (1)	M-F	-597 / 0	0.52 (1)	
F-G	-2578 / 0	-91.8	-91.8 0.56 (1)	M-F	0 / 384	0.09 (1)	
G-H	-2225 / 0	-91.8	-91.8 0.61 (1)	L-F	0 / 417	0.09 (1)	
H-S	-2225 / 0	-91.8	-91.8 0.61 (1)	L-G	-537 / 0	0.52 (1)	
S-I	-2847 / 0	-91.8	-91.8 0.13 (1)	J-P	0 / 111	0.04 (4)	
Q-B	-2009 / 0	0.0	0.0 0.20 (1)	B-S	0 / 2628	0.59 (1)	
				R-S	0 / 1648	0.00 (1)	
				R-H	-1850 / 0	0.19 (1)	
Q-P	0 / 0	-18.5	-18.5 0.15 (4)				
P-O	0 / 2602	-18.5	-18.5 0.49 (1)				
O-N	0 / 2602	-18.5	-18.5 0.49 (1)				
N-M	0 / 2241	-18.5	-18.5 0.43 (1)				
M-L	0 / 2301	-18.5	-18.5 0.46 (1)				
L-K	0 / 2744	-18.5	-18.5 0.53 (1)				
K-J	0 / 2744	-18.5	-18.5 0.53 (1)				
J-R	0 / 2744	-18.5	-18.5 0.68 (1)				
R-I	0 / 1303	-18.5	-18.5 0.45 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = L/999 (0.16)
ALLOWABLE DEFL.(TL) = L/360 (1.17)
CALCULATED VERT. DEFL.(TL) = L/999 (0.30)

CSI: TC=0.58/1.00 (B-C:1), BC=0.69/1.00 (J-R:1), WB=0.59/1.00 (B-P:1), SS=0.31/1.00 (I-R:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618	354	1687
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (P) (INPUT = 0.90)
JSI METAL= 0.98 (I) (INPUT = 1.00)



Structural component only
DWG# T-2008066

JOB NAME 408317	TRUSS NAME T63	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:46 2020 Page 1			

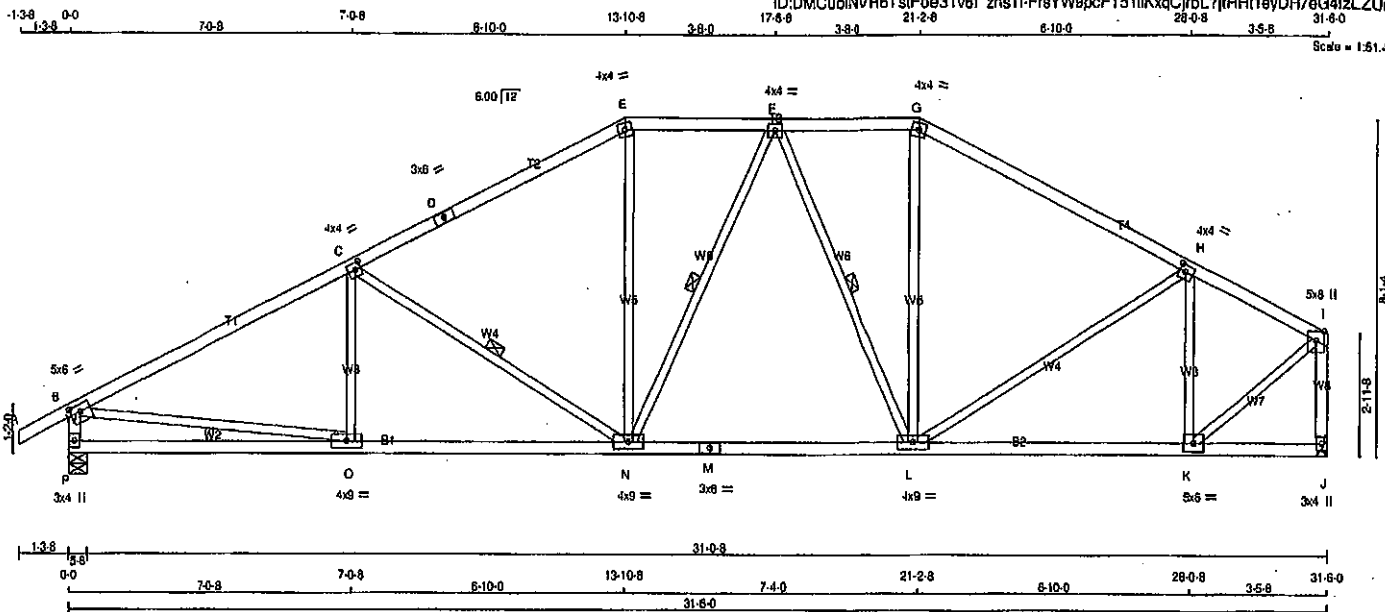

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
P - B	2x4	DRY	No.2
J - I	2x4	DRY	No.2
P - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	5.0	8.0	2.00	2.75
D	TMVW-1	MT20	4.0	4.0	2.00	1.75
G	TS-1	MT20	3.0	8.0		
E	TTW-m	MT20	4.0	4.0		
F	TMVW-1	MT20	4.0	4.0		
G	TTW-m	MT20	4.0	4.0		
H	TMVW-1	MT20	4.0	4.0	2.00	1.75
I	TMVW-p	MT20	5.0	8.0	Edge	
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-1	MT20	5.0	8.0		
L	BMVW-1	MT20	4.0	9.0		
M	BS-1	MT20	3.0	6.0		
N	BMVW-1	MT20	4.0	9.0		
O	BMVW-1	MT20	4.0	9.0		
P	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
P	1861	0	1861	0
J	1736	0	1736	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3'-8".

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
P	1314	875 / 0	0 / 0	0 / 0	0 / 0	438 / 0	0 / 0	
J	1228	808 / 0	0 / 0	0 / 0	0 / 0	422 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.50 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, F-L

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED (LC)	
FR-TO				FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	O-C	-142 / 66	0.05 (1)
B-C	-2544 / 0	-91.8	-91.8 0.77 (1)	3.50	C-N	-680 / 0	0.31 (1)
C-D	-1971 / 0	-91.8	-91.8 0.87 (1)	4.01	N-E	0 / 497	0.11 (1)
D-E	-1971 / 0	-91.8	-91.8 0.87 (1)	4.01	N-F	-8 / 33	0.01 (4)
E-F	-1737 / 0	-91.8	-91.8 0.18 (1)	4.90	F-L	-438 / 0	0.22 (1)
F-G	-1558 / 0	-91.8	-91.8 0.17 (1)	5.12	L-G	0 / 387	0.09 (1)
G-H	-1763 / 0	-91.8	-91.8 0.59 (1)	4.35	L-H	0 / 275	0.08 (1)
H-I	-1428 / 0	-91.8	-91.8 0.43 (1)	4.93	K-H	-907 / 0	0.29 (1)
P-B	-1808 / 0	0.0	0.0 0.18 (1)	6.23	B-O	0 / 2323	0.52 (1)
J-I	-1718 / 0	0.0	0.0 0.27 (1)	8.35	K-I	0 / 1663	0.37 (1)
P-O	0 / 0	-18.5	-18.5 0.21 (4)	10.00			
O-N	0 / 2308	-18.5	-18.5 0.47 (1)	10.00			
N-M	0 / 1740	-18.5	-18.5 0.39 (1)	10.00			
M-L	0 / 1740	-18.5	-18.5 0.39 (1)	10.00			
L-K	0 / 1320	-18.5	-18.5 0.32 (1)	10.00			
K-J	0 / 0	-18.5	-18.5 0.12 (4)	10.00			

TOTAL WEIGHT = 135 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.05")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.05")
CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CSI: TC=0.77/1.00 (B-C:1), BC=0.47/1.00 (N-O:1), WB=0.52/1.00 (B-C:1), SSI=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (E) (INPUT = 0.90)
JSI METAL = 0.89 (B) (INPUT = 1.00)

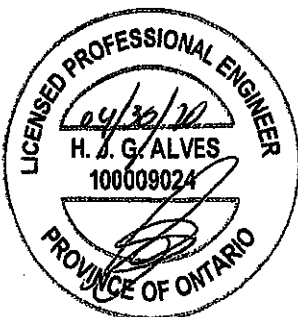

Structural component only
DWG# T-2008067

JOB NAME 408317	TRUSS NAME T64	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:49 2020 Page 1	

ID:DMCubINVR6TsiFoe31v6I_zns11-j1QwivpE0nEuMuv7NvE48YX77qcMm5zMWnNqCzLZUq

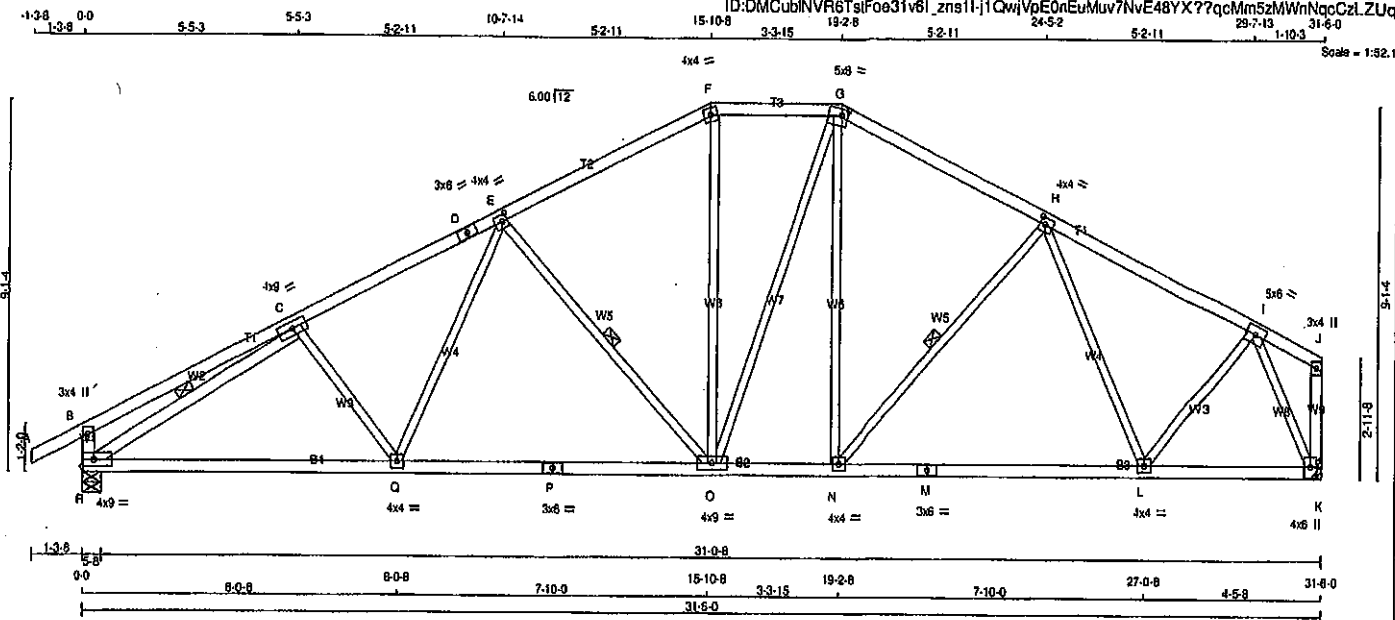

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - G	2x4	DRY	No.2	SPF	
G - J	2x4	DRY	No.2	SPF	
R - B	2x4	DRY	No.2	SPF	
K - J	2x4	DRY	No.2	SPF	
R - P	2x4	DRY	No.2	SPF	
P - M	2x4	DRY	No.2	SPF	
M - K	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
R - C	2x4	DRY	No.2	SPF	

ORY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-I	MT20	4.0	9.0		
D	TS-I	MT20	3.0	6.0		
E	TMWW-I	MT20	4.0	4.0	2.00	1.50
F	TTW-m	MT20	4.0	4.0		
G	TTWW-m	MT20	5.0	6.0	2.00	2.00
H	TMWW-I	MT20	4.0	4.0	2.00	1.50
I	TMWW-I	MT20	5.0	6.0		
J	TMV+p	MT20	3.0	4.0		
K	BMVW1+p	MT20	4.0	6.0		
L, N, Q	BMVW1-I	MT20	4.0	4.0		
M	BS-I	MT20	3.0	6.0		
O	BMVW1-I	MT20	4.0	9.0		
P	BS-I	MT20	3.0	6.0		
R	BMVW1-I	MT20	4.0	9.0		Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
R	1861	0	1861	0
K	1738	0	1738	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT K. MINIMUM BEARING LENGTH AT JOINT K = 3'-8".

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1314	876 / 0	0 / 0	0 / 0	0 / 0	438.0	0 / 0	0 / 0
K	1228	808 / 0	0 / 0	0 / 0	0 / 0	422.0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.14 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O, H-N, C-R.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	CS1 (LC)
FR-TO				FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	C-Q	-156.2	10.00	0.05 (1)
B-C	0 / 20	-91.8	-91.8 0.33 (1)	Q-E	0 / 318	10.00	0.07 (1)
C-D	-2389 / 0	-91.8	-91.8 0.36 (1)	E-O	-708.0	4.14	0.32 (1)
D-E	-2389 / 0	-91.8	-91.8 0.36 (1)	O-F	0 / 434	4.14	0.10 (1)
E-F	-1758 / 0	-91.8	-91.8 0.33 (1)	F-G	0 / 206	4.71	0.05 (1)
F-G	-1657 / 0	-91.8	-91.8 0.16 (1)	G-H	0 / 211	5.14	0.05 (1)
G-H	-1684 / 0	-91.8	-91.8 0.34 (1)	H-I	-140.0	4.78	0.05 (1)
H-I	-1501 / 0	-91.8	-91.8 0.33 (1)	I-J	-570.0	5.01	0.48 (1)
I-J	0 / 33	-91.8	-91.8 0.18 (1)	J-K	0 / 829	10.00	0.19 (1)
J-K	-324 / 0	-91.8	-91.8 0.03 (1)	K-L	-2678.0	7.81	0.54 (1)
K-L	-8 / 0	0.0	0.0 0.00 (1)	L-M	-1906.0	7.81	0.49 (1)
R-O	0 / 2233	-18.5	-18.5 0.52 (1)	M-N	0 / 1575	-18.5	0.00 (1)
O-P	0 / 2014	-18.5	-18.5 0.48 (1)	N-M	0 / 1575	-18.5	0.00 (1)
P-O	0 / 2014	-18.5	-18.5 0.48 (1)	M-L	0 / 1575	-18.5	0.00 (1)
O-N	0 / 1487	-18.5	-18.5 0.33 (1)	L-K	0 / 849	-18.5	0.27 (4)
N-M	0 / 1575	-18.5	-18.5 0.36 (1)				
M-L	0 / 1575	-18.5	-18.5 0.36 (1)				
L-K	0 / 849	-18.5	-18.5 0.27 (4)				

TOTAL WEIGHT = 2 X 142 = 285 lb

(MIF)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 688-09, CSA 688-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.05")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.09")
ALLOWABLE DEFL.(TL) = $L/360$ (1.05")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.21")

CS1: TC=0.38/1.00 (C-E:1), BC=0.52/1.00 (C-R:1), WB=0.54/1.00 (C-R:1), SS1=0.20/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1867
	618	354	1867

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (C) (INPUT = 0.90)
JSI METAL = 0.73 (P) (INPUT = 1.00)




Structural component only
DWG# T-2008068

JOB NAME 408317	TRUSS NAME T85	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:50 2020 Page 1

ID:DMCubtNVR6TstFoe31v6l_zns11-BD_JxrsqnsMl_2UJkdLhm47MEz7VYWWIR7N9ezLZUp

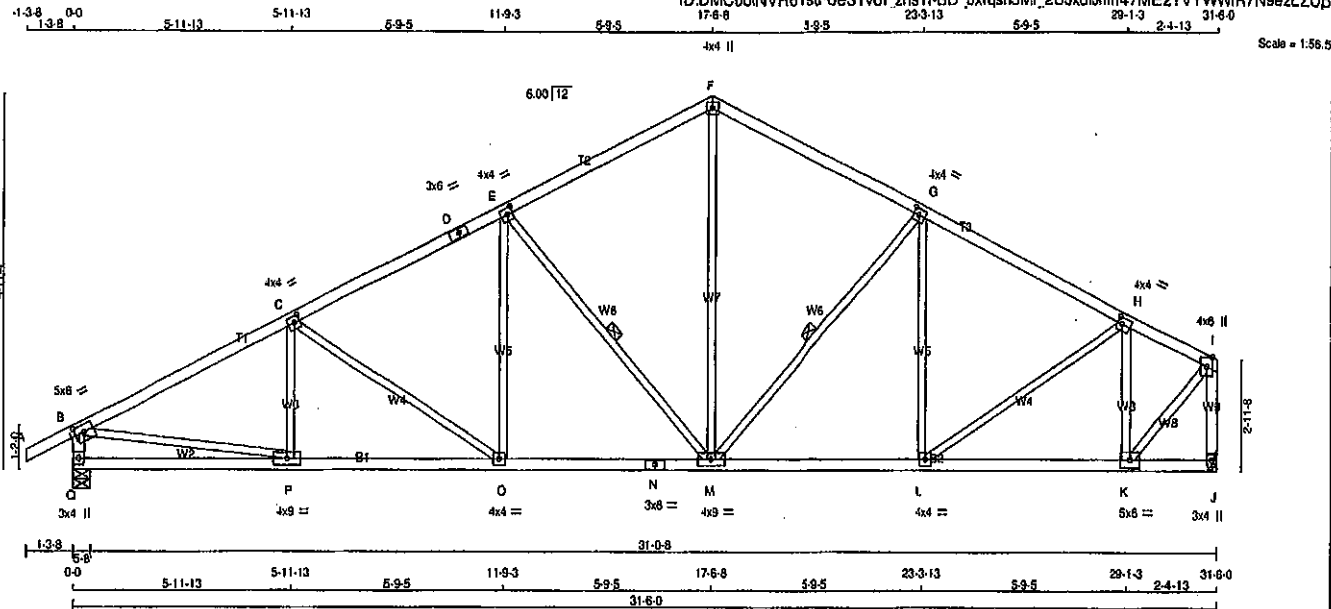

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
Q - B	2x4	DRY	No.2	SPF	
J - I	2x4	DRY	No.2	SPF	
Q - N	2x4	DRY	No.2	SPF	
N - J	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	5.0	6.0	2.25	2.75
C, E, G						
C	TMVW-1	MT20	4.0	4.0	2.00	1.75
D	TS-1	MT20	3.0	6.0		
F	TTW+p	MT20	4.0	4.0		
H	TMVW-1	MT20	4.0	4.0	2.00	1.50
I	TMVW+p	MT20	4.0	6.0	Edge	
J	BMV1+p	MT20	3.0	4.0		
K	BMVW-1	MT20	5.0	6.0		
L	BMVW-1	MT20	4.0	4.0		
M	BMVW+p	MT20	4.0	9.0		
N	BS-1	MT20	3.0	6.0		
O	BMVW-1	MT20	4.0	4.0		
P	BMVW-1	MT20	4.0	9.0		
Q	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
Q	1881	0	1881	0
J	1738	0	1738	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
Q	1314	875 / 0	0 / 0	0 / 0	0 / 0	438 / 0	0 / 0
J	1228	808 / 0	0 / 0	0 / 0	0 / 0	422 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-M, G-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO			
A-B	0 28	-91.8 -91.8 0.12 (1)	10.00	P-C	-208 25	0.06 (1)	
B-C	-2522 / 0	-91.8 -91.8 0.52 (1)	3.88	C-O	-393 / 0	0.38 (1)	
C-D	-2179 / 0	-91.8 -91.8 0.41 (1)	4.24	O-E	0 322	0.07 (1)	
D-E	-2179 / 0	-91.8 -91.8 0.41 (1)	4.24	E-M	-832 / 0	0.45 (1)	
E-F	-1596 / 0	-91.8 -91.8 0.40 (1)	4.80	M-F	0 985	0.22 (1)	
F-G	-1599 / 0	-91.8 -91.8 0.41 (1)	4.79	G-H	-320 / 0	0.17 (1)	
G-H	-1794 / 0	-91.8 -91.8 0.41 (1)	4.58	H-I	-269 / 0	0.23 (1)	
H-I	-1145 / 0	-91.8 -91.8 0.18 (1)	5.74	I-J	0 678	0.15 (1)	
I-J	-1813 / 0	0.0 0.0 0.18 (1)	6.21	J-K	-1072 / 0	0.28 (1)	
J-K	-1728 / 0	0.0 0.0 0.27 (1)	6.33	K-L	0 2289	0.52 (1)	
Q-P	0 / 0	-18.5 -18.5 0.14 (4)	10.00	L-K	0 1595	0.35 (1)	
P-O	0 2278	-18.5 -18.5 0.43 (1)	10.00				
O-N	0 1949	-18.5 -18.5 0.39 (1)	10.00				
N-M	0 1949	-18.5 -18.5 0.39 (1)	10.00				
M-L	0 1818	-18.5 -18.5 0.33 (1)	10.00				
L-K	0 1051	-18.5 -18.5 0.23 (1)	10.00				
K-J	0 0	-18.5 -18.5 0.09 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/380$ (1.05')
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.10')
ALLOWABLE DEFL.(LL) = $L/380$ (1.05')
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.19')

CSI: TC=0.52/1.00 (B-C:1), SC=0.43/1.00 (O-P:1), WB=0.52/1.00 (B-P:1), SSI=0.23/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.89 (P) (INPUT = 0.90)
JSI METAL=0.67 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008069

JOB NAME 408317	TRUSS NAME T66	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:50:52 2020 Page 1		ID:DMCubINVR6TstFoe31v8I_zns11-IQYh8BrUYOUccC3WVKGYDzdLteEZy3fz6sxh3zLZUo	

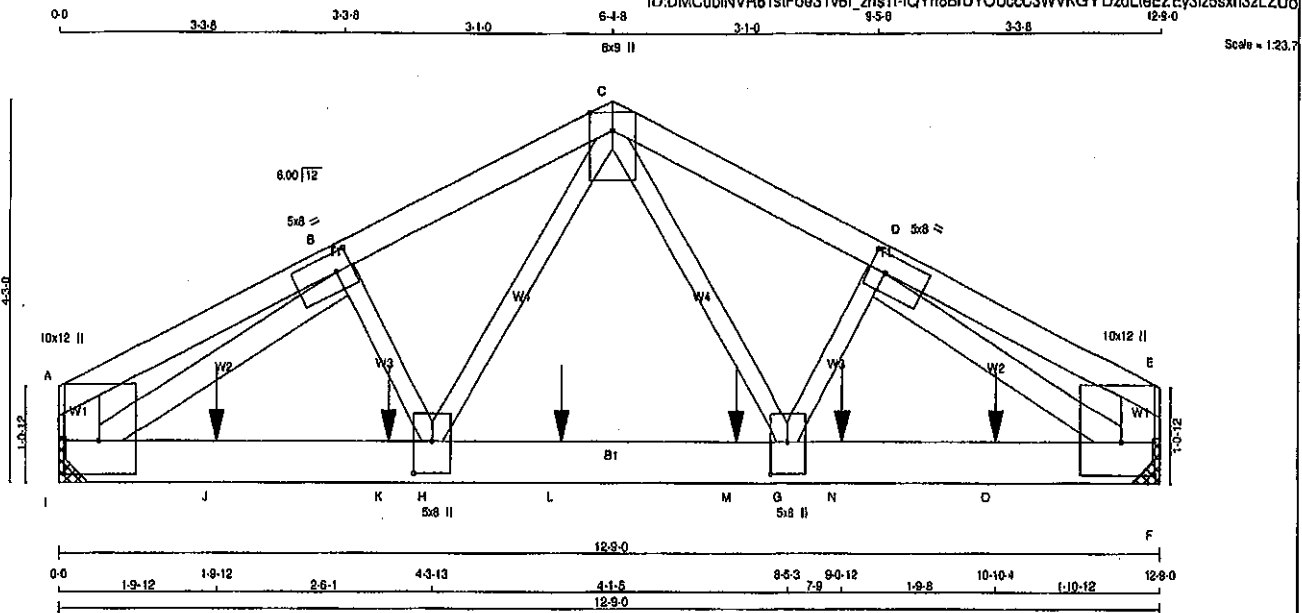

TOTAL WEIGHT = 2 X 58 = 118 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF		
C - E	2x4 DRY	No.2	SPF		
I - A	2x6 DRY	No.2	SPF		
F - E	2x6 DRY	No.2	SPF		
I - F	2x6 DRY	1850F 1.5E	SPF		

ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			
I - B	2x4 DRY	No.2	SPF
D - F	2x4 DRY	No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C	12	TOP
C-E	12	TOP
I-A	12	TOP
F-E	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
I-F	12	SIDE(0.0)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	6	
2x4	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UPLIFT	IN-SX
I	5734	0	0	MECHANICAL
F	5980	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I.F. MINIMUM BEARING LENGTH AT JOINT I = 4-0, JOINT F = 4-0.

UNFACTORED REACTIONS

1ST LOSE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED
I	4050
F	4224

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.19 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	LENGTH	FR-TO	
A-B	-310	-91.8	-91.8 0.09 (1)	C-G	0.4292
B-C	-7793.0	-91.8	-91.8 0.31 (1)	G-D	0.1052
C-D	-8218.0	-91.8	-91.8 0.34 (1)	H-C	0.3477
D-E	-410	-91.8	-91.8 0.10 (1)	E-H	0.978
I-A	-150.0	0.0	0.0 0.01 (1)	I-B	-8011.0
F-E	-154.0	0.0	0.0 0.01 (1)	D-F	-9439.0
I-J	0.6530	-18.5	-18.5 0.69 (1)		
J-K	0.6530	-18.5	-18.5 0.69 (1)		
K-H	0.6530	-18.5	-18.5 0.69 (1)		
H-L	0.5338	-18.5	-18.5 0.57 (1)		
L-M	0.5338	-18.5	-18.5 0.57 (1)		
M-G	0.5338	-18.5	-18.5 0.57 (1)		
G-N	0.6878	-18.5	-18.5 0.72 (1)		
N-O	0.6878	-18.5	-18.5 0.72 (1)		
O-F	0.6878	-18.5	-18.5 0.72 (1)		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
J	1-9-12	-1718	-1718	---	BACK	VERT	TOTAL	C1
K	3-9-12	-1718	-1718	---	BACK	VERT	TOTAL	C1
L	5-9-12	-1718	-1718	---	BACK	VERT	TOTAL	C1
M	7-9-12	-1718	-1718	---	BACK	VERT	TOTAL	C1
N	9-0-12	-1718	-1718	---	BACK	VERT	TOTAL	C1
O	10-10-4	-1718	-1718	---	BACK	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.43")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (0.43")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CSI: TC=0.34/1.00 (C-D:1), BC=0.72/1.00 (F-G:1), WB=0.75/1.00 (D-F:1), SS=0.88/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (DI) (INPUT = 0.90)

JSI METAL= 0.76 (DI) (INPUT = 1.00)



Structural component only
DWG# T-2008070

CONTINUED ON PAGE 2

JOB NAME 408317	TRUSS NAME T66	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 6 Oct 2019 MiTek Industries, Inc. Thu Apr 30 10:50:52 2020 Page 2 ID:DMCubINVR6TstFoe31v6I_zns1I-7c63MXs6JicTDMei22nmB9Wd2aozPJpCkUDXzLZUn			

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A, E, F, I					
A	TMBMW1'+pMT20	10.0	12.0	4.50	4.75
B	TMWW-I MT20	5.0	8.0	2.50	2.25
C	TTWW+p MT20	6.0	9.0	Edge	
D	TMWW-I MT20	5.0	8.0	2.50	2.25
E	TMBMW1'+pMT20	10.0	12.0	4.50	4.75
G	BMWW-I MT20	5.0	8.0	4.25	2.50
H	BMWW-I MT20	5.0	8.0	4.25	2.50

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.




Structural component only
DWG# T-2008070 7/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408317	T67S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:50:53 2020 Page 1
ID:DMCubINVR6TsIFoe31v6I zns11-bogRZssk40kKwWduelQIOikUS2fzzyRPL1zzLZUm

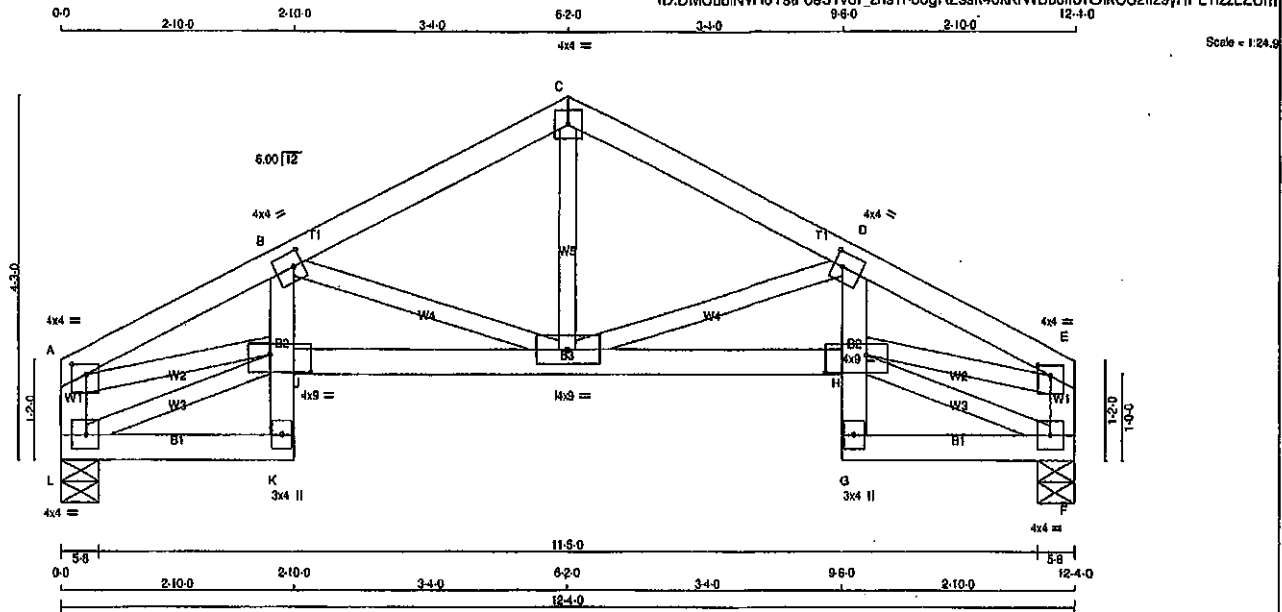

TOTAL WEIGHT = 52 lb (M/F)

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
L - A	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
L - K	2x4	DRY	No.2	SPF
K - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
G - D	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)							
JT	TYPE	PLATES	W	LEN	Y	X	
A	TMVW-p	MT20	4.0	4.0	1.50	2.00	
B	TMVW-l	MT20	4.0	4.0	2.00	1.25	
C	TTW-p	MT20	4.0	4.0			
D	TMVW-t	MT20	4.0	4.0	2.00	1.25	
E	TMVW-p	MT20	4.0	4.0	1.50	2.00	
F	BMVW1-l	MT20	4.0	4.0			
G	BMV-p	MT20	3.0	4.0			
H	BMVWV-l	MT20	4.0	8.0	2.50	6.00	
I	BMVWV-l	MT20	4.0	8.0			
J	BMVWV-l	MT20	4.0	8.0	2.50	6.00	
K	BMV-p	MT20	3.0	4.0			
L	BMVW1-l	MT20	4.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	SNOW	GROSS REACTION	BRG	IN-SX	IN-SX		
L	680	0	880	0	0	5-8	5-8		
F	680	0	880	0	0	5-8	5-8		

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN	COMPONENT REACTIONS						
L	481	318 / 0	0 / 0	0 / 0	0 / 0	165 / 0	0 / 0		
F	481	318 / 0	0 / 0	0 / 0	0 / 0	165 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1	MAX. UNBRACED	MEMB.	FORCE (LBS)	MAX. UNBRACED	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	LENGTH	FR-TO			FR-TO	
A-B	-1320 / 0	-91.8	-91.8	0.09 (1)	5.55	I-C	0 / 443	0.10 (1)	
B-C	-818 / 0	-91.8	-91.8	0.14 (1)	6.25	I-D	-559 / 0	0.13 (1)	
C-D	-818 / 0	-91.8	-91.8	0.14 (1)	6.25	B-I	-559 / 0	0.13 (1)	
D-E	-1320 / 0	-91.8	-91.8	0.09 (1)	5.55	L-J	-74 / 0	0.01 (1)	
L-A	-829 / 0	0.0	0.0	0.08 (1)	7.81	A-J	0 / 1193	0.27 (1)	
F-E	-829 / 0	0.0	0.0	0.08 (1)	7.81	H-E	-74 / 0	0.01 (1)	
L-K	0 / 89	-18.5	-18.5	0.04 (4)	10.00				
K-J	0 / 28	0.0	0.0	0.10 (1)	10.00				
J-B	0 / 87	0.0	0.0	0.11 (1)	10.00				
J-I	0 / 1249	-18.5	-18.5	0.24 (1)	10.00				
I-H	0 / 1249	-18.5	-18.5	0.24 (1)	10.00				
G-H	0 / 28	0.0	0.0	0.10 (1)	10.00				
H-D	0 / 87	0.0	0.0	0.11 (1)	10.00				
G-F	0 / 89	-18.5	-18.5	0.04 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.41")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.03")
ALLOWABLE DEFL.(TL) = $L/360$ (0.41")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.06")

CSI: TC=0.14/1.00 (B-C:1), BC=0.24/1.00 (I-J:1),
WB=0.27/1.00 (A-J:1), SS=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.86 (E) (INPUT = 0.80)
JSI METAL= 0.40 (A) (INPUT = 1.00)



Structural component only
DWG# T-2008071

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408317	T67SX	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Metek Industries, Inc. Thu Apr 30 16:50:54 2020 Page 1
ID:DMCubInVR6TstFoe31v6L_zns11-4?DpnCImrJsBTgo5ASqFrcFvDrObRQ?5g25bPlZLZUI

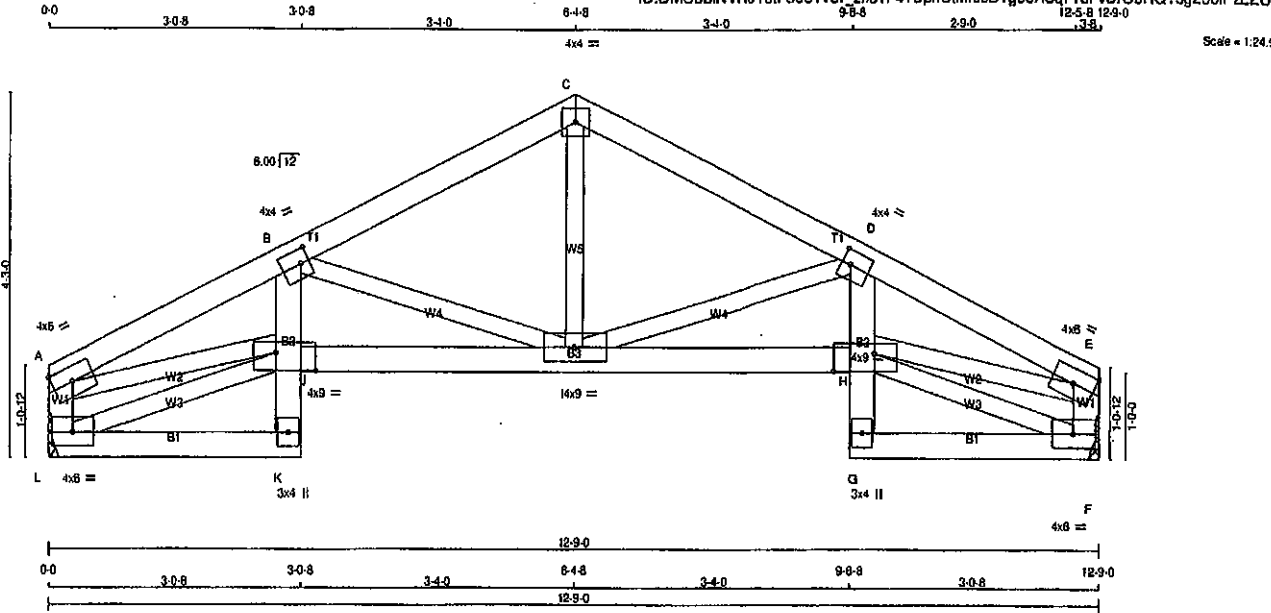

Scale = 1/24.9

TOTAL WEIGHT = 59 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
L - A	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
L - K	2x4	DRY	No.2	SPF	
K - B	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
G - D	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	4.0	6.0	Edge		
B	TMVW-1	MT20	4.0	4.0	2.00	1.25	
C	TTW-p	MT20	4.0	4.0			
D	TMVW-1	MT20	4.0	4.0	2.00	1.25	
E	TMVW-1	MT20	4.0	6.0	Edge		
F	BMVW1-1	MT20	4.0	6.0			
G	BMVW1-1	MT20	3.0	4.0			
H	BMVW1-1	MT20	4.0	9.0	2.50	5.75	
I	BMVW1-1	MT20	4.0	9.0			
J	BMVW1-1	MT20	4.0	9.0	2.50	5.75	
K	BMVW1-1	MT20	3.0	4.0			
L	BMVW1-1	MT20	4.0	6.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	9RG	9RG	
JT	VERT	HORZ	DOWN	HORZ
L	703	0	703	0
F	703	0	703	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT L. F. MINIMUM BEARING LENGTH AT JOINT L = 1-8, JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN. SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	497	328 / 0	0 / 0	0 / 0	0 / 0	171 / 0	0 / 0
F	497	328 / 0	0 / 0	0 / 0	0 / 0	171 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.35 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	FORCE	VERT. LOAD	LC1	MAX	MAX.	UNBRAC	MEMB.	MAX. FACTORED	FORCE	MAX
FR-TO	FROM	TO	LENGTH	FR-TO	FROM	TO	LENGTH	FR-TO	FROM	TO	LENGTH	FR-TO
A-B	-1445 / 0	-91.8	-91.8	0.10 (1)	5.35	B-I	-634 / 0	0.15 (1)				
B-C	-871 / 0	-91.8	-91.8	0.14 (1)	6.25	I-C	0 / 493	0.11 (1)				
C-D	-871 / 0	-91.8	-91.8	0.14 (1)	6.25	I-D	-633 / 0	0.15 (1)				
D-E	-1444 / 0	-91.8	-91.8	0.10 (1)	5.35	L-J	-66 / 0	0.02 (1)				
L-A	-648 / 0	0.0	0.0	0.07 (1)	7.81	A-J	0 / 1307	0.29 (1)				
F-E	-648 / 0	0.0	0.0	0.07 (1)	7.81	H-F	-66 / 0	0.02 (1)				
L-K	0 / 81	-18.5	-18.5	0.05 (4)	10.00	H-E	0 / 1308	-0.29 (1)				
K-J	0 / 30	0.0	0.0	0.11 (1)	10.00							
J-B	0 / 135	0.0	0.0	0.13 (1)	10.00							
J-I	0 / 1370	-18.5	-18.5	0.25 (1)	10.00							
I-H	0 / 1369	-18.5	-18.5	0.25 (1)	10.00							
G-H	0 / 30	0.0	0.0	0.11 (1)	10.00							
H-D	0 / 134	0.0	0.0	0.13 (1)	10.00							
G-F	0 / 81	-18.5	-18.5	0.05 (4)	10.00							

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.0	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPO 2011, TPO 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.43")
CALCULATED VERT. DEFL.(LL) = $L/888$ (0.04")
ALLOWABLE DEFL.(TL) = $L/360$ (0.43")
CALCULATED VERT. DEFL.(TL) = $L/989$ (0.07")

CSI: TC=0.14/1.00 (C-D:1), BC=0.25/1.00 (I-J:1), WB=0.29/1.00 (A-J:1), SS=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	
MAX MIN	MAX MIN	MAX MIN	
MT20	616	354	1667
	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.78 (A) (INPUT = 0.90)
JSI METAL= 0.38 (E) (INPUT = 1.00)



Structural component only
DWG# T-2008072

JOB NAME 408317	TRUSS NAME T68	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 \$ Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:50:54 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-47DpnCtMrJsBTgo5ASqFrcFuGrHPrRit5g25bIPzLZU
5-10-8

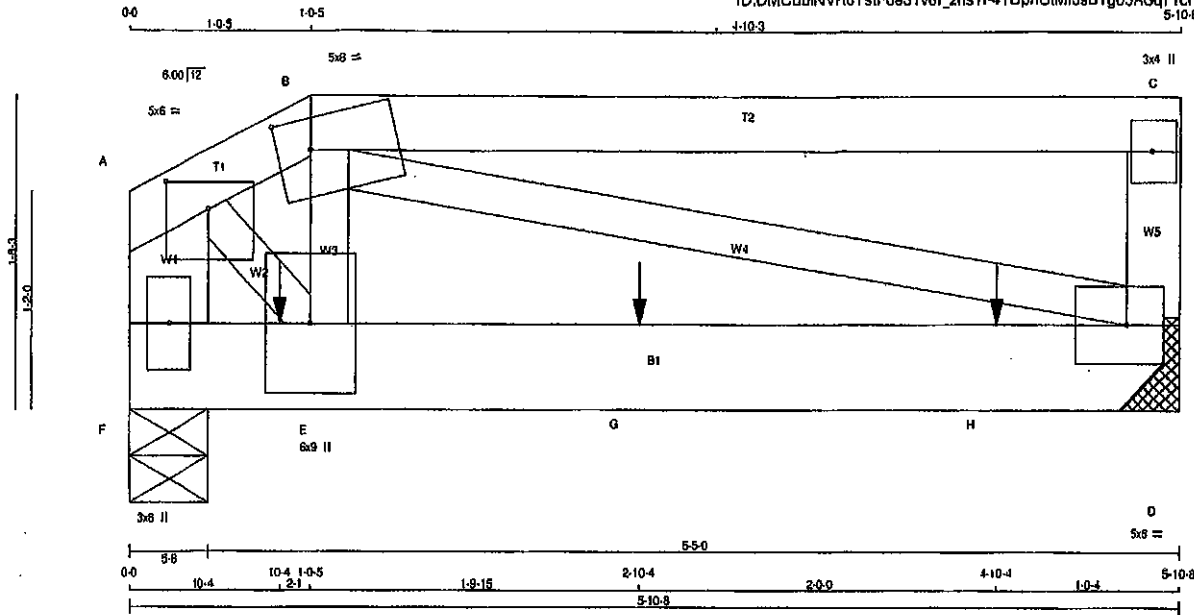

TOTAL WEIGHT = 2 X 25 = 49 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF	
B - C	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	
F - A	2x8	DRY	No.2	SPF	
F - D	2x8	DRY	1650F 1.5E	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - B	12	TOP
B - C	12	TOP
C - D	12	TOP
F - A	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D	6	SIDE (427.3)
WEBS : (0.122"x3") SPIRAL NAILS		
E - B	2	SIDE (95.7)
2x3	1	6

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A - TMVW-p	MT20	5.0	6.0	1.75	3.00	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			MAXIMUM FACTORED		INPUT	REQD
	FACTORED		GROSS REACTION		BRG	BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
JT						IN-SX
D	3340	0	3340	0	0	MECHANICAL
F	3319	0	3319	0	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
JT COMBINED	1580 / 0	0 / 0	0 / 0	775 / 0	0 / 0
D	1570 / 0	0 / 0	0 / 0	771 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.57 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO							
A - B	-4328 / 0	-91.8	-91.8	0.07 (1)	4.57	E - B	0 / 2791
B - C	0 / 0	-91.8	-91.8	0.20 (1)	10.00	B - D	-4223 / 0
D - C	-222 / 0	0.0	0.0	0.01 (1)	7.81	A - E	0 / 4573
F - A	-4847 / 0	0.0	0.0	0.16 (1)	6.70		
F - E	0 / 0	-18.5	-18.5	0.39 (1)	10.00		
E - G	0 / 4080	-18.5	-18.5	0.89 (1)	10.00		
G - H	0 / 4080	-18.5	-18.5	0.89 (1)	10.00		
H - D	0 / 4080	-18.5	-18.5	0.89 (1)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
E	10-4	-2005	-2005	---	FRONT	VERT	TOTAL	---	C1
G	2-10-4	-2003	-2003	---	FRONT	VERT	TOTAL	---	C1
H	4-10-4	-2003	-2003	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 240 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/989 (0.07")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/547 (0.13")

CSI: TC=0.20/1.00 (B-C:1), BC=0.69/1.00 (D-E:1), WB=0.81/1.00 (B-D:1), SS=0.89/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MT20	818	354
	1687	768
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (B) (INPUT = 0.90)
JSI METAL = 0.81 (E) (INPUT = 1.00)



Structural component only
DWG# T-2008073

CONTINUED ON PAGE 2


JOB NAME 408317	TRUSS NAME T68	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington


Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:50:54 2020 Page 2
ID:DMCubINVR6TstFce31v6I zns11-47DnCIMJsbTq05ASqFrcFuGrHpRII5q25blPzLZU

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TTWW-m	MT20	5.0	8.0	2.00	2.25
C	TMV+p	MT20	3.0	4.0		
D	BMVW1-l	MT20	5.0	6.0	2.50	2.50
E	BMVW+l	MT20	6.0	9.0		
F	BMV1+p	MT20	3.0	6.0		

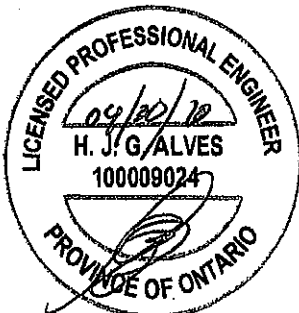

Structural component only
DWG# T-2008073

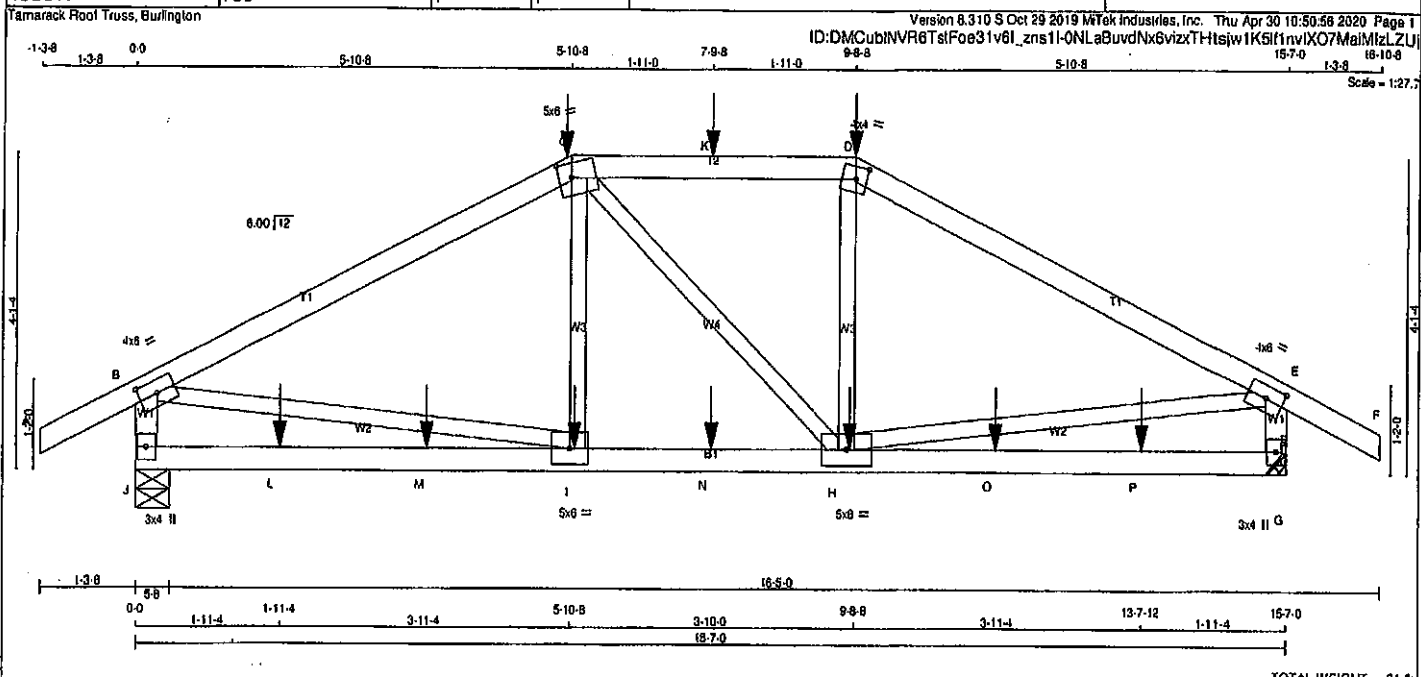

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
J - B	2x4	DRY No.2	SPF
G - E	2x4	DRY No.2	SPF
J - G	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-1	MT20	4.0	8.0	2.00	3.00
C	TMWV-m	MT20	5.0	8.0	2.25	2.00
D	TMW-m	MT20	4.0	4.0	2.00	1.75
E	TMWV-1	MT20	4.0	8.0	2.00	3.00
G	BMV1-p	MT20	3.0	4.0		
H	BMWVW-1	MT20	5.0	8.0		
I	BMWVW-1	MT20	5.0	8.0		
J	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
J	1544	0	1544	0
G	1543	0	1543	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	1091	722 / 0	0 / 0	0 / 0	0 / 0	369 / 0	0 / 0
G	1090	722 / 0	0 / 0	0 / 0	0 / 0	369 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.85 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 CSI (LC)	MAX. UNBRAC	MEMB.	FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO		LENGTH	FR-TO			
A-B	0 / 28	-91.8	-91.8	0.13 (1)	10.00	I-C	-76 / 105	0.04 (4)
B-C	-1873 / 0	-91.8	-91.8	0.78 (1)	3.88	C-H	0 / 3	0.00 (4)
C-K	-1874 / 0	-91.8	-91.8	0.47 (1)	4.49	H-D	-73 / 107	0.04 (4)
K-D	-1874 / 0	-91.8	-91.8	0.47 (1)	4.49	B-I	0 / 1691	0.42 (1)
D-E	-1876 / 0	-91.8	-91.8	0.78 (1)	3.85	H-E	0 / 1694	0.42 (1)
E-F	0 / 28	-91.8	-91.8	0.13 (1)	10.00			
F-G	-1474 / 0	0.0	0.0	0.16 (1)	6.71			
G-E	-1473 / 0	0.0	0.0	0.16 (1)	6.71			
J-L	0 / 0	-18.5	-18.5	0.28 (4)	10.00			
L-M	0 / 0	-18.5	-18.5	0.28 (4)	10.00			
M-I	0 / 0	-18.5	-18.5	0.28 (4)	10.00			
I-N	0 / 1872	-18.5	-18.5	0.40 (1)	10.00			
N-H	0 / 1872	-18.5	-18.5	0.40 (1)	10.00			
H-O	0 / 0	-18.5	-18.5	0.28 (4)	10.00			
O-P	0 / 0	-18.5	-18.5	0.28 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LOC.	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-414	-414	---	FRONT	VERT	TOTAL	---	C1
D	9-8-8	-414	-414	---	FRONT	VERT	TOTAL	---	C1
H	9-7-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
I	5-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
K	7-9-8	-110	-110	---	FRONT	VERT	TOTAL	---	C1
L	1-11-4	-25	-25	---	FRONT	VERT	TOTAL	---	C1
M	3-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
N	7-9-8	-28	-28	---	FRONT	VERT	TOTAL	---	C1
O	11-7-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
P	13-7-12	-25	-25	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.52")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.04")
ALLOWABLE DEFL. (TL) = $L/360$ (0.52")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.11")

CSL TO = 0.78/1.00 (D-E:1), BC = 0.40/1.00 (H-I:1), WB = 0.42/1.00 (E-H:1), SS = 0.21/1.00 (D-E:1)

DOL LUMBER = 1.00 NAIL = 1.00 LS BEND = 1.00
COMP = 1.00 SHEAR = 1.00 TENS = 1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1867	788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (E) (INPUT = 0.80)

JSI METAL = 0.51 (E) (INPUT = 1.00)

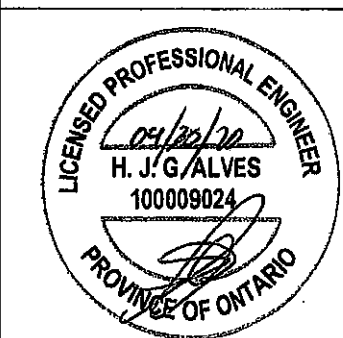

Structural component only
DWG# T-2008074

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408317	T70	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

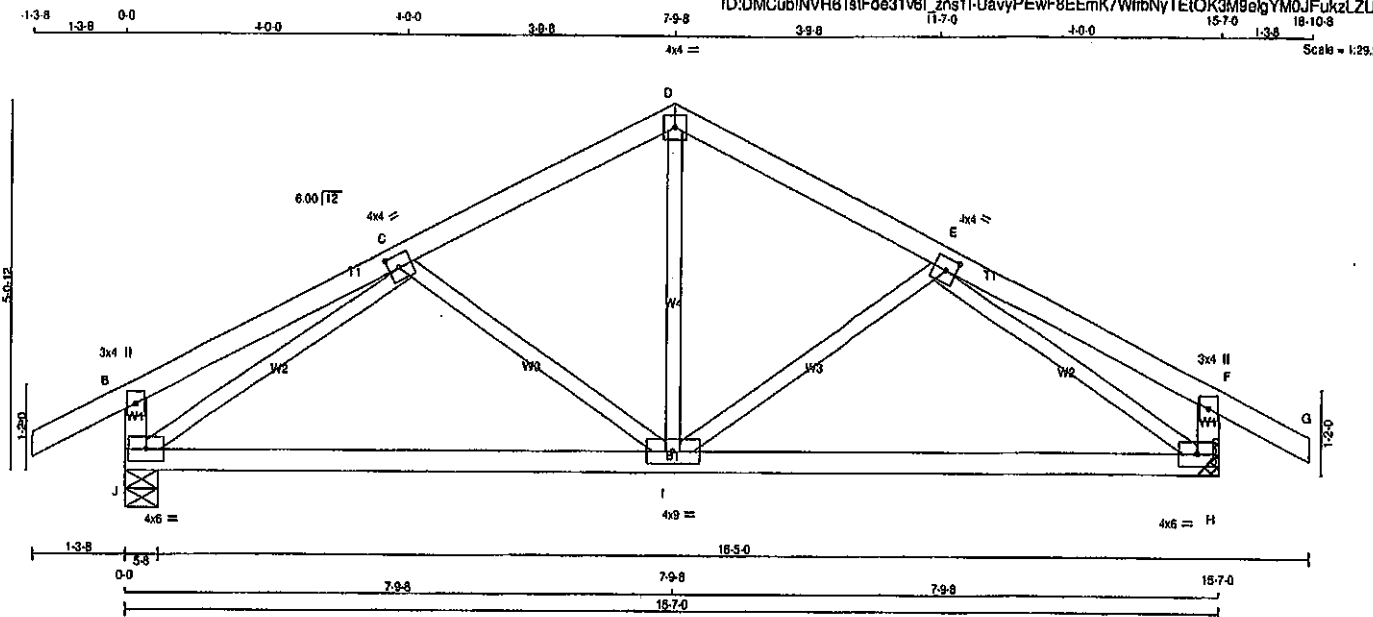

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - H	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY, SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV-p	MT20	3.0	4.0	
C	TMWW-I	MT20	4.0	4.0	2.00 1.75
D	TTW-p	MT20	4.0	4.0	
E	TMWW-I	MT20	4.0	4.0	2.00 1.75
F	TMV-p	MT20	3.0	4.0	
H	BMVW1-I	MT20	4.0	6.0	
I	BMVW1-I	MT20	4.0	9.0	
J	BMVW1-I	MT20	4.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORIZ	IN-SX
J	984	0	984	0	5-8
H	984	0	984	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3'-8".

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS	PERM	LIVE	WIND	DEAD	SOIL
J	683	488 / 0	0 / 0	0 / 0	0 / 0	0 / 0	225 / 0	0 / 0
H	683	488 / 0	0 / 0	0 / 0	0 / 0	0 / 0	225 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)	MAX	LC1 MAX
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 28	-91.8	-91.8 0.12 (1)	I-D	0 / 455	0.10 (1)	
B-C	0 / 18	-91.8	-91.8 0.21 (1)	I-E	-237 / 0	0.09 (1)	
C-D	-835 / 0	-91.8	-91.8 0.17 (1)	C-I	-237 / 0	0.09 (1)	
D-E	-835 / 0	-91.8	-91.8 0.17 (1)	J-C	-1137 / 0	0.43 (1)	
E-F	0 / 18	-91.8	-91.8 0.21 (1)	E-H	-1137 / 0	0.43 (1)	
F-G	0 / 28	-91.8	-91.8 0.12 (1)				
J-I	-284 / 0	0.0	0.0 0.03 (1)				
H-F	-284 / 0	0.0	0.0 0.03 (1)				
J-I	0 / 923	-18.5	-18.5 0.39 (4)				
I-H	0 / 923	-18.5	-18.5 0.39 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2018
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.52")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.02")
ALLOWABLE DEFL.(TL) = $L/360$ (0.52")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.10")

CSI: TC=0.21/1.00 (E-F:1), BC=0.39/1.00 (I-J:4),
WB=0.43/1.00 (C-J:1), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1687
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.91 (E) (INPUT = 0.90)
JSI METAL= 0.38 (E) (INPUT = 1.00)




Structural component only
DWG# T-2008075

JOB NAME 408317	TRUSS NAME T71	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:50:58 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns1l-ymTKcawtYMDxH5sPluB7SPa?TkNEChag3oRAzLZUh

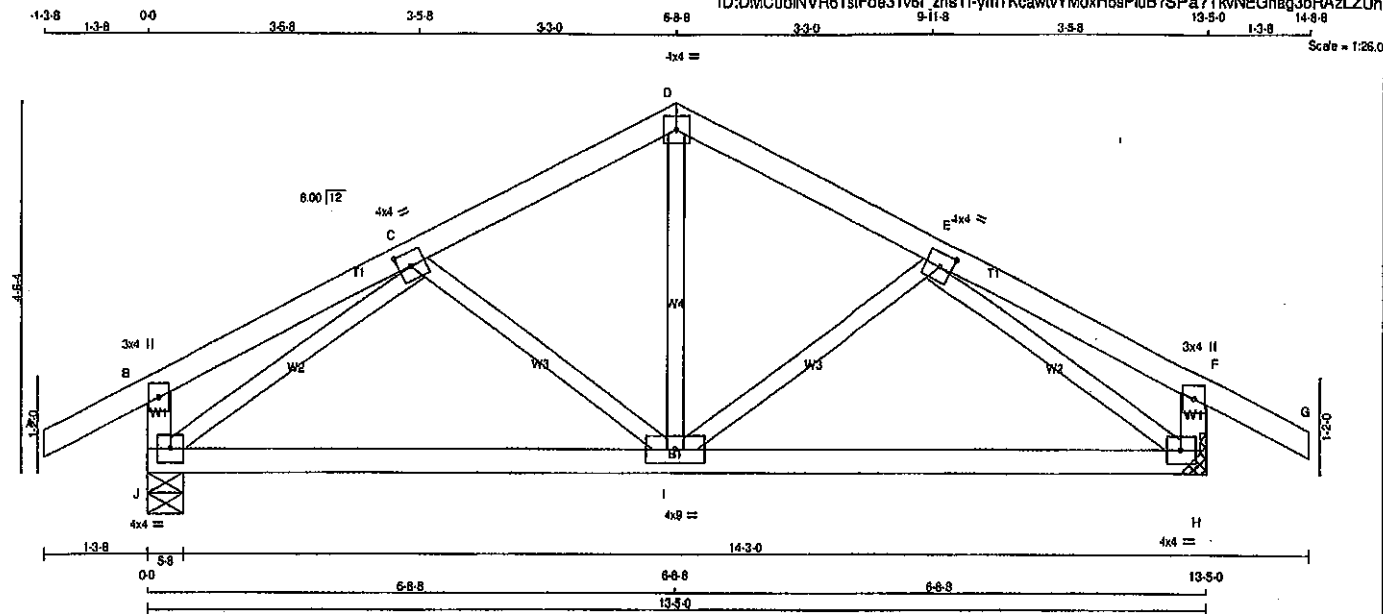

TOTAL WEIGHT = 2 X 53 = 107 lb [M/F]

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
J - B	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-1	MT20	4.0	4.0	2.00	1.75
D	TTW-p	MT20	4.0	4.0		
E	TMWW-1	MT20	4.0	4.0	2.00	1.75
F	TMV+p	MT20	3.0	4.0		
H	BMVW1-1	MT20	4.0	4.0		
I	BMVWW-1	MT20	4.0	9.0		
J	BMVW1-1	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
J	864	0	864	0
H	864	0	864	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	COMBINED	809	413/0	0/0	0/0	0/0	196/0	0/0
H	COMBINED	809	413/0	0/0	0/0	0/0	196/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORIZ. LOAD (PLF)	MAX. FACTORED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (PLF)
FR-TO						FR-TO			
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00	I-D	0/371	0.08 (1)	
B-C	0/15	-91.8	-91.8	0.15 (1)	10.00	I-E	-181/0	0.05 (1)	
C-D	-688/0	-91.8	-91.8	0.12 (1)	6.25	C-I	-181/0	0.05 (1)	
D-E	-688/0	-91.8	-91.8	0.12 (1)	6.25	J-C	-948/0	0.28 (1)	
E-F	0/15	-91.8	-91.8	0.15 (1)	10.00	E-H	-948/0	0.28 (1)	
F-G	0/28	-91.8	-91.8	0.12 (1)	10.00				
J-B	-246/0	0.0	0.0	0.02 (1)	7.81				
H-F	-246/0	0.0	0.0	0.02 (1)	7.81				
J-I	0/755	-18.5	-18.5	0.29 (4)	10.00				
I-H	0/755	-18.5	-18.5	0.29 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/G

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.45")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.45")
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CSI: TC=0.15/1.00 (E-F:1), BC=0.29/1.00 (H-I:4),
WB=0.28/1.00 (E-H:1), SS=0.13/1.00 (E-F:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.85 (J) (INPUT = 0.90)
JSI METAL= 0.32 (E) (INPUT = 1.00)



Structural component only
DWG# T-2008076

JOB NAME 408317	TRUSS NAME T72S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 5 Oct 2019 MTek Industries, Inc. Thu Apr 30 10:50:59 2020 Page 1
ID:DMCubINVR6TslFoe31v6l_zns1l-Qy1lqxVgsUUAZg2z0PCYfy0s3j6frpK0MzdZLZUg

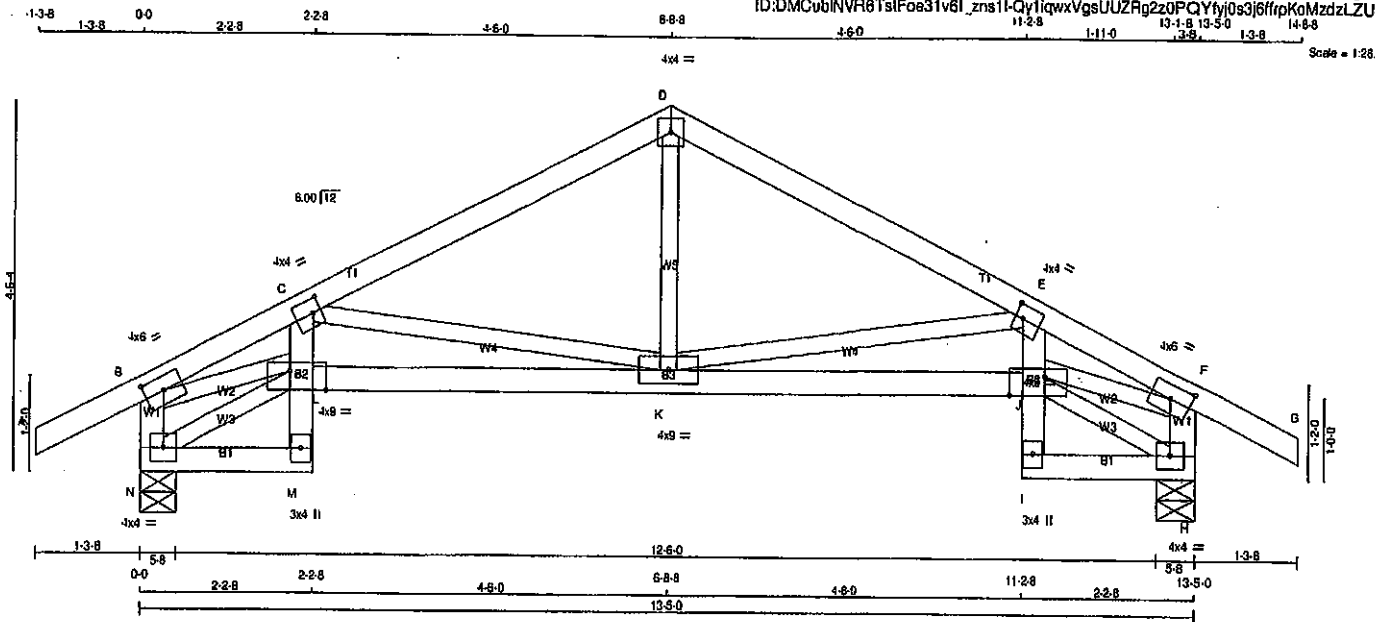

TOTAL WEIGHT = 2 X 57 = 114 lb
[M/F]

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
N - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
N - M	2x4	DRY	No.2
M - C	2x4	DRY	No.2
L - J	2x4	DRY	No.2
I - E	2x4	DRY	No.2
I - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	8.0	2.00	3.00
C	TMVW-1	MT20	4.0	4.0	2.00	1.25
D	TTW-p	MT20	4.0	4.0		
E	TMVW-1	MT20	4.0	4.0	2.00	1.25
F	TMVW-1	MT20	4.0	6.0	2.00	3.00
H	BMVW-1	MT20	4.0	4.0		
I	BMV-p	MT20	3.0	4.0		
J	BMVW-1	MT20	4.0	9.0	2.75	5.50
K	BMVW-1	MT20	4.0	9.0		
L	BMVW-1	MT20	4.0	9.0	2.75	5.50
M	BMV-p	MT20	3.0	4.0		
N	BMVW-1	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
N	864	0	864	0
H	864	0	864	0

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
N	COMBINED		413/0	0/0	0/0	0/0	196/0	0/0
H			413/0	0/0	0/0	0/0	196/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.0 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0.28	-91.8	-91.8	10.00	K-D	0.7412	0.09 (1)
B-C	-1816/0	-91.8	-91.8	0.15 (1)	5.07	K-E	-812/0
C-D	-892/0	-91.8	-91.8	0.29 (1)	8.18	C-K	-812/0
D-E	-892/0	-91.8	-91.8	0.29 (1)	8.18	N-L	-116/0
E-F	-1616/0	-91.8	-91.8	0.15 (1)	5.07	B-L	0.1472
F-G	0.28	-91.8	-91.8	0.12 (1)	10.00	J-H	-116/0
N-B	-795/0	0.0	0.0	0.09 (1)	7.81	J-F	0.1472
H-F	-795/0	0.0	0.0	0.09 (1)	7.81		
N-M	0.104	-18.5	-18.5	0.03 (4)	10.00		
M-L	0.21	0.0	0.0	0.14 (1)	10.00		
L-C	0.102	0.0	0.0	0.16 (1)	10.00		
L-K	0.1585	-18.5	-18.5	0.32 (1)	10.00		
K-J	0.1585	-18.5	-18.5	0.32 (1)	10.00		
I-J	0.21	0.0	0.0	0.14 (1)	10.00		
J-E	0.102	0.0	0.0	0.16 (1)	10.00		
I-H	0.104	-18.5	-18.5	0.03 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.45")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL) = L/360 (0.45")
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CSI: TC=0.26/1.00 (D-E:1), BC=0.32/1.00 (J-K:1),
WB=0.33/1.00 (F-J:1), SS=0.17/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1887
	788	1987	1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.88 (C) (INPUT = 0.90)
JSI METAL = 0.43 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008077

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	V30	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:55:39 2020 Page 1		ID:DMCubINVR6TstFoe31v6l_zns11-3ggRys0LE8oPFQkHdmca3lwzQoqoZKTM9wRWGzLa9A	
		TRAUSS DESC.			

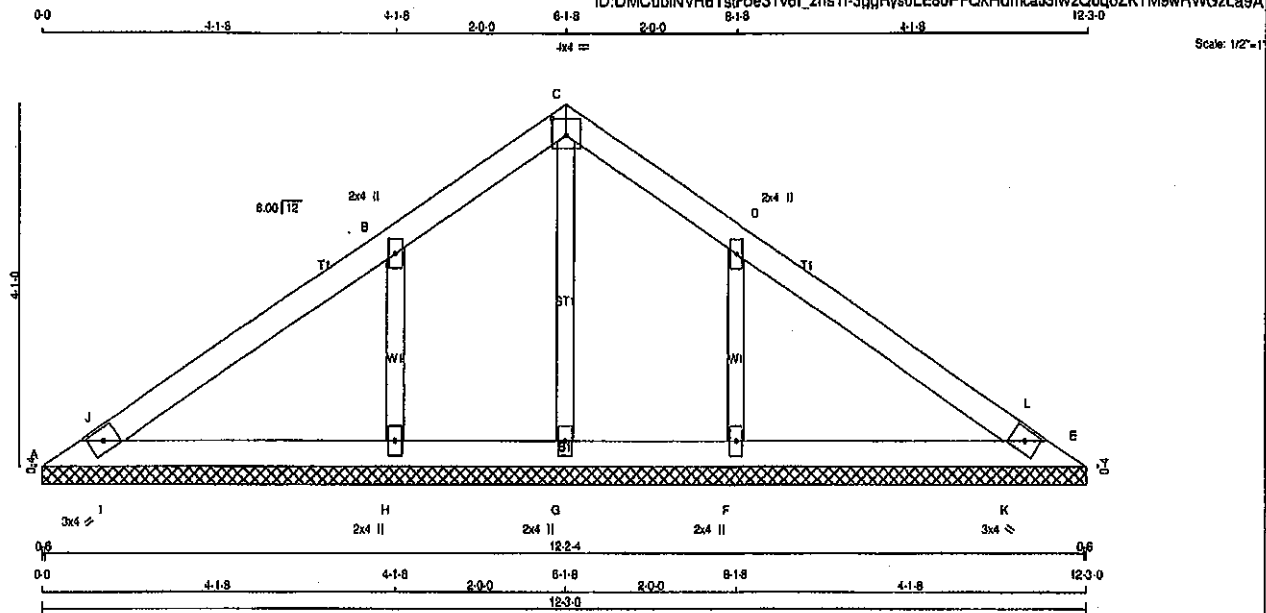

TOTAL WEIGHT = 38 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DRY
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
A - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
SPF			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TBM1-h	MT20	3.0	4.0	
B	TMW+w	MT20	2.0	4.0	
C	TTW+p	MT20	4.0	4.0	2.25 2.00
D	TMW+w	MT20	2.0	4.0	
E	TBM1-h	MT20	3.0	4.0	
F, G, H	BMW1+w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	UPLIFT	IN-SX	IN-SX	
A	102	0	102	0	12-3-0	12-2-4	2-3-0
E	102	0	102	0	12-3-0	12-2-4	2-3-0
G	252	0	252	0	12-3-0	12-2-4	2-3-0
H	444	0	444	0	12-3-0	12-2-4	2-3-0
F	444	0	444	0	12-3-0	12-2-4	2-3-0

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST LOSE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	72	48/0	0/0	0/0	0/0	24/0	0/0
E	72	48/0	0/0	0/0	0/0	24/0	0/0
G	178	115/0	0/0	0/0	0/0	84/0	0/0
H	314	208/0	0/0	0/0	0/0	108/0	0/0
F	314	208/0	0/0	0/0	0/0	108/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, G, H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. (LC)	MEMB.	FORCE (LBS)	MAX. (LC)	
FR-TO		FROM	TO	FR-TO			
A-J	0/150	-91.8	-91.8 0.04 (4)	10.00	G-C	-291/0	0.07 (1)
J-B	0/183	-91.8	-91.8 0.17 (1)	10.00	H-B	-318/0	0.05 (1)
B-C	0/151	-91.8	-91.8 0.18 (1)	10.00	F-D	-318/0	0.05 (1)
C-D	0/151	-91.8	-91.8 0.18 (1)	10.00	I-J	-119/3	0.00 (1)
D-L	0/183	-91.8	-91.8 0.17 (1)	10.00	K-L	-119/3	0.00 (1)
L-E	0/150	-91.8	-91.8 0.04 (4)	10.00			
A-I	-158/0	-18.5	-18.5 0.10 (1)	6.25			
I-H	-137/0	-18.5	-18.5 0.10 (1)	6.25			
H-G	-148/0	-18.5	-18.5 0.08 (1)	6.25			
G-F	-148/0	-18.5	-18.5 0.08 (1)	6.25			
F-K	-137/0	-18.5	-18.5 0.10 (1)	6.25			
K-E	-158/0	-18.5	-18.5 0.10 (1)	6.25			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD				= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 8, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 8 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.17/1.00 (B-J:1), BC=0.10/1.00 (H-I:1), WB=0.07/1.00 (C-G:1), SS=0.12/1.00 (B-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.24 (C) (INPUT = 0.90)

JSI METAL = 0.18 (D) (INPUT = 1.00)



Structural component only
DWG# T-2008048

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	V31	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MITak Industries, Inc. Thu Apr 30 10:05:40 2020 Page 1	

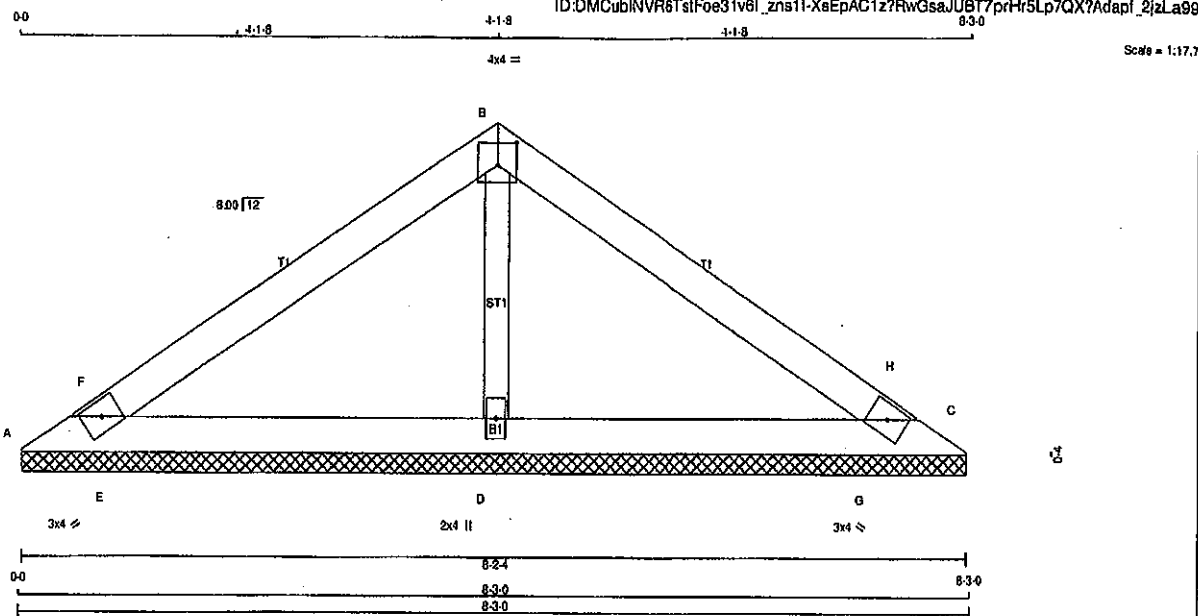

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	DESCR.
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
A - C	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
A - TBM1-h	MT20	3.0	4.0		
B - TTW-p	MT20	4.0	4.0	2.25	2.00
C - TBM1-h	MT20	3.0	4.0		
D - BMW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
A	61	0	61	0	8-2-4	8-2-4	8-2-4
C	61	0	61	0	8-2-4	8-2-4	8-2-4
D	780	0	780	0	8-2-4	8-2-4	8-2-4

UNFACTORED REACTIONS

1ST CASE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	43	28 / 0	0 / 0	0 / 0	0 / 0	15 / 0	0 / 0
C	43	28 / 0	0 / 0	0 / 0	0 / 0	15 / 0	0 / 0
D	552	382 / 0	0 / 0	0 / 0	0 / 0	190 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED				WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LC1 (LBS)	MAX. (LBS)	UNBRAC	MEMB.	MAX. FORCE (LBS)	MAX. (LBS)	CSI (LC)
FR-TO						FR-TO			
A-F	0 / 280	-91.8	-91.8	0.09 (1)	10.00	D-B	-598 / 0	0.10 (1)	
F-B	0 / 279	-91.8	-91.8	0.19 (1)	10.00	E-F	-195 / 0	0.00 (1)	
B-H	0 / 279	-91.8	-91.8	0.19 (1)	10.00	G-H	-195 / 0	0.00 (1)	
H-C	0 / 280	-91.8	-91.8	0.09 (1)	10.00				
A-E	-284 / 0	-18.5	-18.5	0.14 (1)	6.25				
E-D	-237 / 0	-18.5	-18.5	0.14 (1)	6.25				
D-G	-237 / 0	-18.5	-18.5	0.14 (1)	6.25				
G-C	-284 / 0	-18.5	-18.5	0.14 (1)	6.25				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 8, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 8 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.19/1.00 (B-F:1), BC=0.14/1.00 (D-E:1), WB=0.10/1.00 (B-C:1), SS=0.10/1.00 (B-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PLI)	SECTION (PLI)
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788
	1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.50 (B) (INPUT = 0.80)
JSI METAL= 0.17 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008049

JOB NAME 408315	TRUSS NAME PB1	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 09:31:23 2020 Page 1		ID:DMCubINVR6TsIFoe31v6l_zns11-G8RBRr8hQQm8aTz8Bzkr_V8akd5i4i6raHdLRzLa1f	

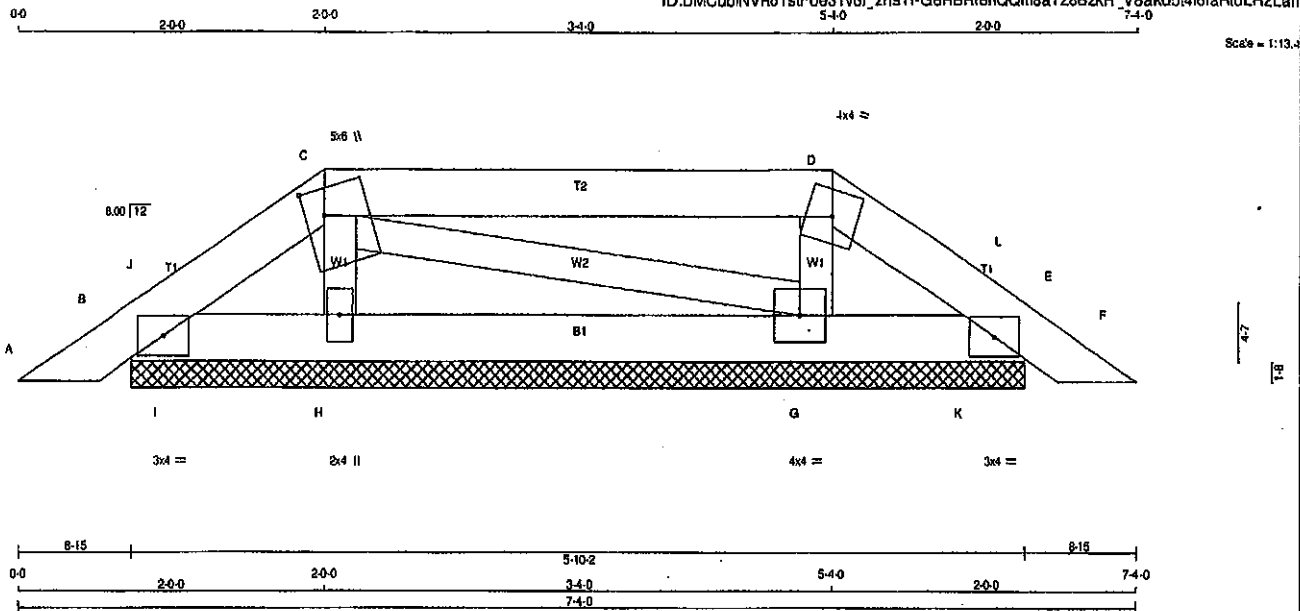

TOTAL WEIGHT = 19 k (M)

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
B - E	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	DOWN	HORIZ	JT	GROSS REACTION	DOWN	HORIZ	BRG	BRG
B	148	0	148	0	0	0	0	5-10-2	5-10-2
E	144	0	144	0	0	0	0	5-10-2	5-10-2
H	233	0	233	0	0	0	0	5-10-2	5-10-2
G	241	0	241	0	0	0	0	5-10-2	5-10-2

UNFACTORED REACTIONS

1ST CASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
B	102	81/0	0/0	0/0	0/0	21/0	0/0
E	99	78/0	0/0	0/0	0/0	21/0	0/0
H	166	101/0	0/0	0/0	0/0	65/0	0/0
G	172	108/0	0/0	0/0	0/0	66/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT.	LOAD LC1 MAX (PLF)	MEMB.	FORCE (LBS)	VERT.	LOAD LC1 MAX (PLF)
FR-TO				FR-TO			
A-B	0/15	-91.8	-91.8 0.03 (1)	H-C	-169/0	0.02 (1)	
B-J	-45/0	-91.8	-91.8 0.03 (4)	C-G	-7/0	0.00 (1)	
J-C	-46/0	-91.8	-91.8 0.01 (1)	G-D	-175/0	0.02 (1)	
C-D	-11/0	-91.8	-91.8 0.17 (1)	I-J	-58/0	0.00 (1)	
D-L	-38/0	-91.8	-91.8 0.01 (1)	K-L	-59/0	0.00 (1)	
L-E	-37/0	-91.8	-91.8 0.00 (4)				
E-F	0/15	-91.8	-91.8 0.03 (1)				
B-I	0/37	-18.5	-18.5 0.02 (1)				
I-H	0/37	-18.5	-18.5 0.03 (4)				
H-G	0/18	-18.5	-18.5 0.03 (4)				
G-K	0/31	-18.5	-18.5 0.03 (4)				
K-E	0/31	-18.5	-18.5 0.02 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 26.6	PSF
DL	= 6.0	PSF	
BOT CH.	LL	= 0.0	PSF
DL	= 7.4	PSF	
TOTAL LOAD	= 39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS: TC=0.17/1.00 (C-D:1), BC=0.03/1.00 (H-I:4), WB=0.02/1.00 (D-G:1), SS=0.12/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
		788	1987
			1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.12 (D) (INPUT = 0.99)
JSI METAL= 0.04 (H) (INPUT = 1.00)




Structural component only
DWG# T-2007999

JOB NAME 408315	TRUSS NAME PB2	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 09:31:24 2020 Page 1
ID:DMCubINVR6TsiFoe31v6I_zrst1-kK?ZIB9JBku?Cd8KkgFgWinlnIQ7p9Q?pxcBluzLafH

Scale = 1"=15.0'

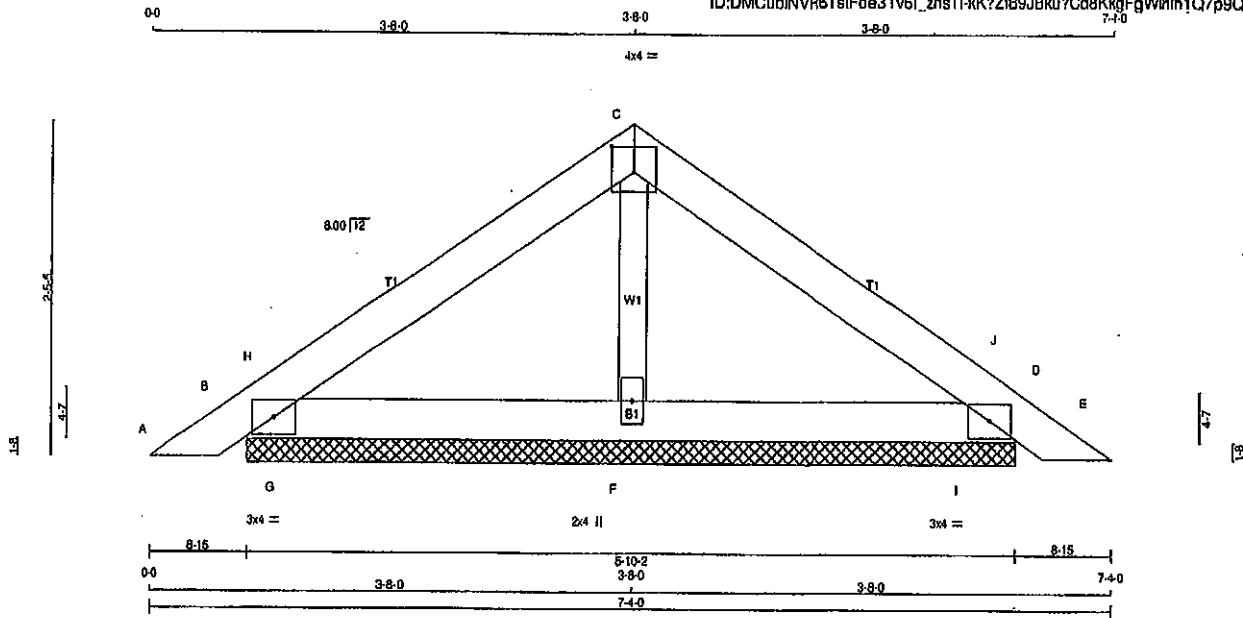

TOTAL WEIGHT = 4 X 18 = 72 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
B - D	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	3.0	4.0	
C	YTW-p	MT20	4.0	4.0	2.25 2.00
D	TMB1-I	MT20	3.0	4.0	
F	BNW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
B	252	0	252	0	0	5-10-2	5-10-2
D	252	0	252	0	0	5-10-2	5-10-2
F	252	0	252	0	0	5-10-2	5-10-2

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	178	127 / 0	0 / 0	0 / 0	0 / 0	49 / 0	0 / 0
D	178	127 / 0	0 / 0	0 / 0	0 / 0	49 / 0	0 / 0
F	187	113 / 0	0 / 0	0 / 0	0 / 0	74 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)	MAX. UNBRAC	MAX. CSI (LC)
FR-TO		FROM	TO	FR-TO		LENGTH	FR-TO
A-B	0 / 15	-91.8	-91.8 0.03 (1)	10.00	F-C	-128 / 0	0.02 (1)
B-H	-37 / 0	-91.8	-91.8 0.04 (1)	6.25	G-H	-219 / 0	0.00 (1)
H-C	-90 / 0	-91.8	-91.8 0.09 (1)	6.25	I-J	-219 / 0	0.00 (1)
C-J	-90 / 0	-91.8	-91.8 0.09 (1)	6.25			
J-D	-37 / 0	-91.8	-91.8 0.04 (1)	6.25			
D-E	0 / 15	-91.8	-91.8 0.03 (1)	10.00			
B-G	0 / 71	-18.5	-18.5 0.10 (1)	10.00			
G-F	0 / 71	-18.5	-18.5 0.10 (1)	10.00			
F-I	0 / 71	-18.5	-18.5 0.10 (1)	10.00			
I-D	0 / 71	-18.5	-18.5 0.10 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.09/1.00 (C-H:1), BC=0.10/1.00 (B-G:1), WB=0.02/1.00 (C-F:1), SSI=0.15/1.00 (B-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1857 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.22 (D) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)

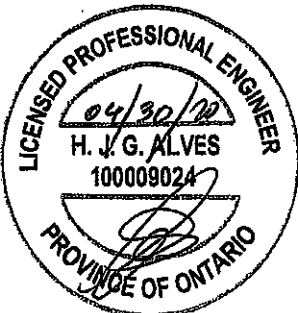

Structural component only
DWG# T-2008000

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	PB3	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:26 2020 Page 1	

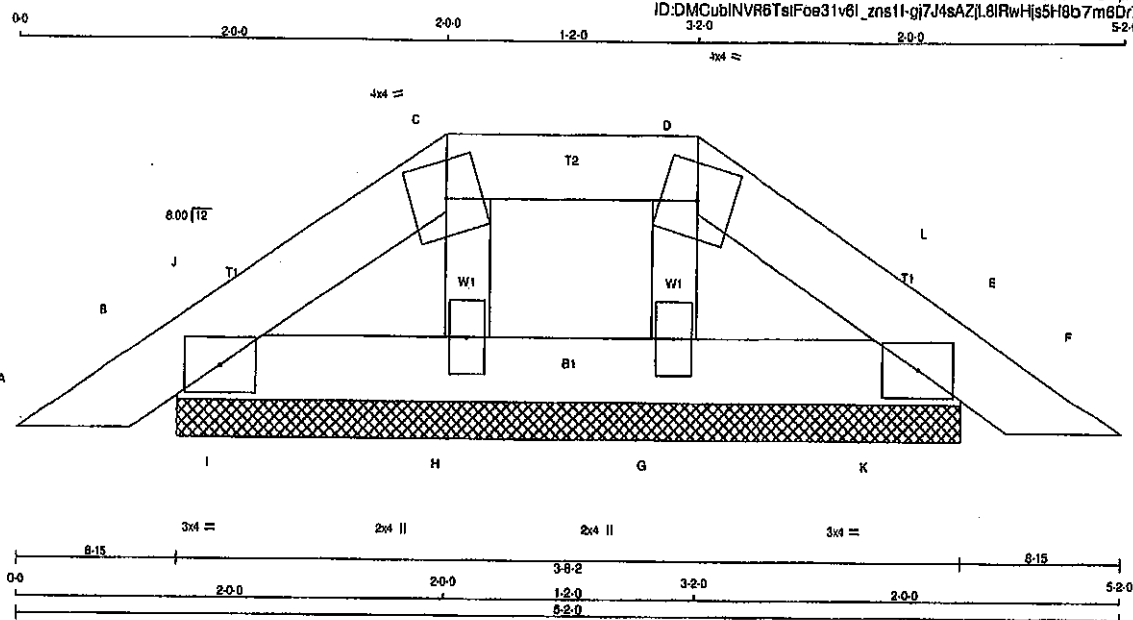

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
B - F	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table in inches)	W	LEN	Y	X
JT TYPE	PLATES			
B	TMB1-I	MT20	3.0	4.0
C	TTW-m	MT20	4.0	4.0
D	TTW-m	MT20	4.0	4.0
E	TMB1-I	MT20	3.0	4.0
G	BMW1+ew	MT20	2.0	4.0
H	BMW1+ew	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
B	VERT	DOWN	144	144
E	VERT	DOWN	144	144
H	VERT	DOWN	119	119
G	VERT	DOWN	119	119

UNFACTORED REACTIONS

1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
B	101	74/0	0/0	0/0	0/0	27/0	0/0
E	101	74/0	0/0	0/0	0/0	27/0	0/0
H	85	54/0	0/0	0/0	0/0	31/0	0/0
G	85	54/0	0/0	0/0	0/0	31/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.
FR-TO								FR-TO						
A-B	0/15	-91.8	-91.8	0.03	(1)	10.00	H-C	-84/0	0.01	(1)				
B-J	-34/0	-91.8	-91.8	0.00	(4)	8.25	G-D	-84/0	0.01	(1)				
J-C	-27/0	-91.8	-91.8	0.02	(1)	8.25	I-J	-46/0	0.00	(1)				
C-D	-14/0	-91.8	-91.8	0.02	(1)	8.25	K-L	-46/0	0.00	(1)				
D-L	-27/0	-91.8	-91.8	0.02	(1)	8.25								
L-E	-34/0	-91.8	-91.8	0.00	(4)	6.25								
E-F	0/15	-91.8	-91.8	0.03	(1)	10.00								
B-I	0/23	-18.5	-18.5	0.02	(1)	10.00								
I-H	0/23	-18.5	-18.5	0.02	(1)	10.00								
H-G	0/14	-18.5	-18.5	0.01	(1)	10.00								
G-K	0/23	-18.5	-18.5	0.02	(1)	10.00								
K-E	0/23	-18.5	-18.5	0.02	(1)	10.00								

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
DL	=	6.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.03/1.00 (A-B:1), BC=0.02/1.00 (E-K:1), WB=0.01/1.00 (D-G:1), SS=0.04/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
	788	1887	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.11 (E) (INPUT = 0.90)
JSI METAL = 0.02 (B) (INPUT = 1.00)

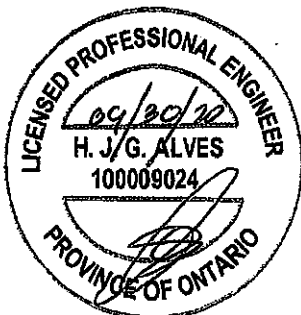

Structural component only
DWG# T-2008001

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	PB4	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 09:31:27 2020 Page 1	

ID:DMCubINVR6TstF0e31v6I_zns11-8vhiHCBBUIGZ34svQooN8LJHvETH0WHRVrrUCzLaIE

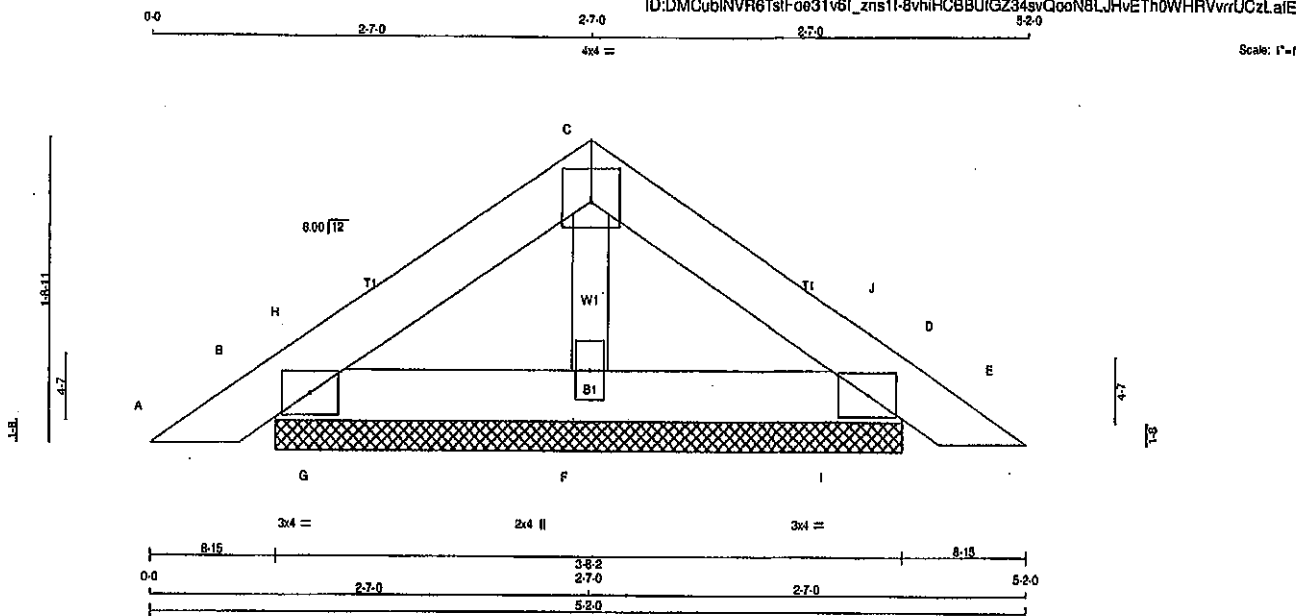

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
B - D	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	3.0	4.0	
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TMB1-I	MT20	3.0	4.0	
F	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
B	175	0	175	0	0	3-8-2	3-8-2
D	175	0	175	0	0	3-8-2	3-8-2
F	175	0	175	0	0	3-8-2	3-8-2

UNFACTORED REACTIONS

1ST CASE		MAX/MIN COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	COMBINED	SNOW	LIVE	PERM. LIVE
B	122	89/0	0/0	0/0	0/0	33/0	0/0	122	89/0	0/0	0/0
D	122	89/0	0/0	0/0	0/0	33/0	0/0	122	89/0	0/0	0/0
F	127	78/0	0/0	0/0	0/0	49/0	0/0	127	78/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		W E B S		MAX. FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (LBS)	MAX. (PLF)	MEMB.	MAX. FORCE (LBS)	MAX. (PLF)	MAX. (LC)
FR-TO				FR-TO			
A-B	0/15	-91.8	-91.8 0.03 (1)	F-C	-86/0	0.01 (1)	
B-H	-35/0	-91.8	-91.8 0.01 (1)	G-H	-93/0	0.00 (1)	
H-C	-45/0	-91.8	-91.8 0.03 (1)	I-J	-99/0	0.00 (1)	
G-J	-45/0	-91.8	-91.8 0.03 (1)				
J-D	-35/0	-91.8	-91.8 0.01 (1)				
D-E	0/15	-91.8	-91.8 0.03 (1)				
B-G	0/36	-18.5	-18.5 0.04 (1)				
G-F	0/36	-18.5	-18.5 0.04 (1)				
F-I	0/36	-18.5	-18.5 0.04 (1)				
I-D	0/36	-18.5	-18.5 0.04 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.F. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.03/1.00 (C-J:1), BC=0.04/1.00 (F-C:1), WB=0.01/1.00 (C-F:1), SS=0.07/1.00 (D-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (D) (INPUT = 0.90)
JSI METAL = 0.03 (B) (INPUT = 1.00)




Structural component only
DWG# T-2008002

JOB NAME 408315	TRUSS NAME PB5	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 09:31:29 2020 Page 1
 ID:DMCubINVR6TstFoe31v8l_zns11-5HpSiUdS7GWHIOIIXDqrDmOd628sUQkkyDKxZ5zLaIC

Scale = 1:13.5

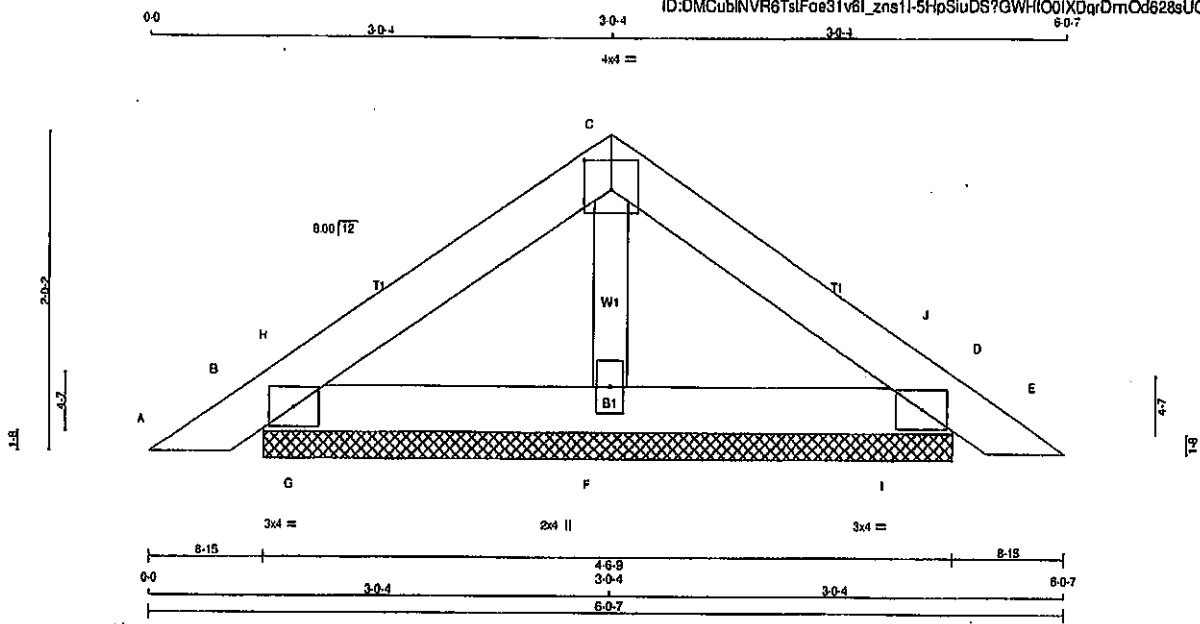

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
B - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TM81-I	MT20	3.0	4.0	
C	TTW-P	MT20	4.0	4.0	2.25 2.00
D	TM81-I	MT20	3.0	4.0	
F	BMW1+W	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
B	205	0	205	0	4-8-9	4-8-9
O	205	0	205	0	4-8-9	4-8-9
F	213	0	213	0	4-8-9	4-8-9

UNFACTORED REACTIONS

JT	1ST LCASE		MAX. MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	143	104 / 0	0 / 0	0 / 0	0 / 0	39 / 0	0 / 0
D	143	104 / 0	0 / 0	0 / 0	0 / 0	39 / 0	0 / 0
F	152	92 / 0	0 / 0	0 / 0	0 / 0	59 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	CS (L/C)
FR-TO		FROM TO		FR-TO			
A-B	0 / 15	-91.8 -91.8 0.03 (1)	10.00	F-C	-104 / 0	0.02 (1)	
B-H	-38 / 0	-91.8 -91.8 0.02 (1)	8.25	G-H	-141 / 0	0.00 (1)	
H-C	-62 / 0	-91.8 -91.8 0.05 (1)	8.25	I-J	-141 / 0	0.00 (1)	
C-J	-62 / 0	-91.8 -91.8 0.05 (1)	8.25				
J-D	-38 / 0	-91.8 -91.8 0.02 (1)	8.25				
D-E	0 / 15	-91.8 -91.8 0.03 (1)	10.00				
B-G	0 / 49	-18.5 -18.5 0.08 (1)	10.00				
G-F	0 / 49	-18.5 -18.5 0.08 (1)	10.00				
F-I	0 / 49	-18.5 -18.5 0.08 (1)	10.00				
I-D	0 / 49	-18.5 -18.5 0.08 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
OL = 6.0 PSF
BOT CH. LL = 0.0 PSF
OL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.05/1.00 (C-H:1), BC=0.08/1.00 (B-G:1), WB=0.02/1.00 (C-F:1), SS=0.10/1.00 (B-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	818 354 1887 788 1987 1856	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.17 (B) (INPUT = 0.90)
JSI METAL= 0.04 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008003

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408315	PB5Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington Version 8.310 S Oct 29 2019 MTak Industries, Inc. Thu Apr 30 09:31:30 2020 Page 1
ID:DMCubINVR6TstFos31v8I_zns11-ZUMqwED4mae8wYbU5xM4mzxoGSUZD5i8t4V5XzLa7B

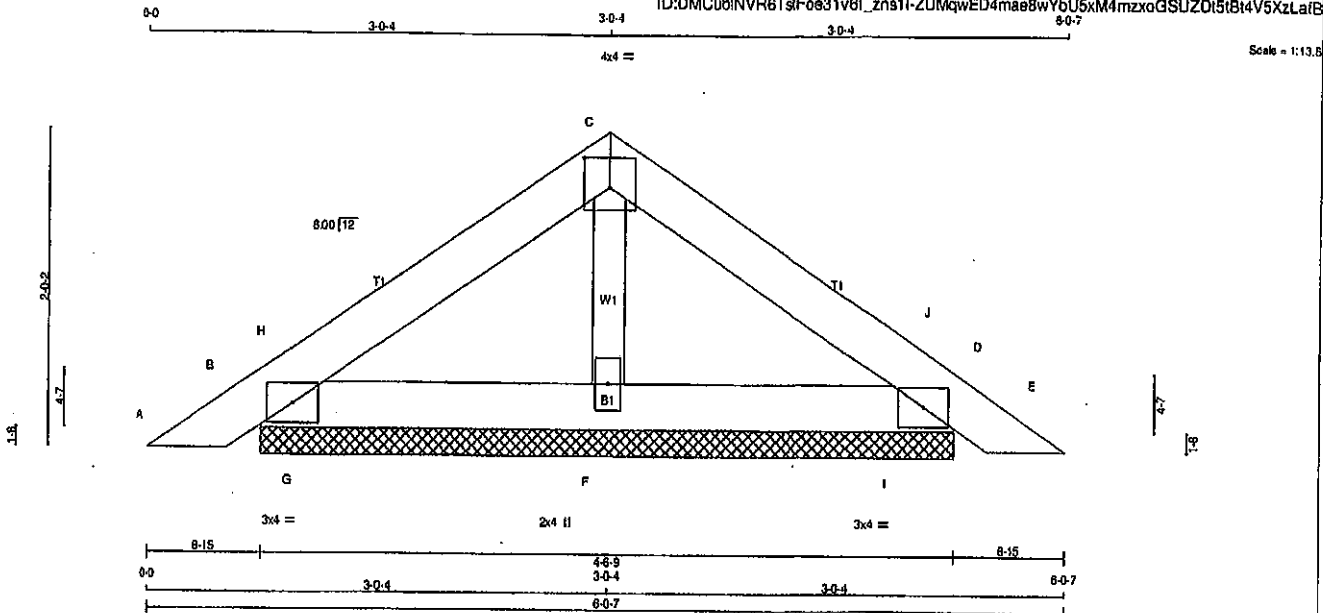

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No2			SPF
C - E	2x4 DRY	No2			SPF
B - D	2x4 DRY	No2			SPF
ALL WEBS	2x3 DRY	No2			SPF
DRY: SEASONED LUMBER.					

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C 1 12		TOP
C-E 1 12		TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
B-D 1 12		TOP
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1 8		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B-TMB1-I	MT20	3.0	4.0			
C-TTW-p	MT20	4.0	4.0	2.25	2.00	
D-TMB1-I	MT20	3.0	4.0			
F-BMW1-w	MT20	2.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
B	208	0	208	0
D	208	0	208	0
F	212	0	212	0

UNFACTORED REACTIONS	1ST LOASE	MAX MIN COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
B	144	104/0 0/0 0/0 0/0 39/0 0/0
D	144	104/0 0/0 0/0 0/0 39/0 0/0
F	151	92/0 0/0 0/0 0/0 59/0 0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LCI (LC)	MAX. FACTORED UNBRAC LENGTH (LC)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LCI (LC)
FR-TO					FR-TO		
A-B	0/15	-91.8	-91.8	0.01 (1)	F-C	-104/0	0.01 (1)
B-H	-40/0	-91.8	-91.8	0.01 (1)	G-H	-139/0	-0.00 (1)
H-C	-82/0	-91.8	-91.8	0.03 (1)	I-J	-139/0	0.00 (1)
C-J	-82/0	-91.8	-91.8	0.03 (1)			
J-D	-40/0	-91.8	-91.8	0.01 (1)			
D-E	0/15	-91.8	-91.8	0.01 (1)			
B-G	0/49	-18.5	-18.5	0.03 (1)			
G-F	0/49	-18.5	-18.5	0.03 (1)			
F-I	0/49	-18.5	-18.5	0.03 (1)			
I-D	0/49	-18.5	-18.5	0.03 (1)			

TOTAL WEIGHT = 2 X 14 = 28 lb (M)

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.03/1.00 (C-H1), BC=0.03/1.00 (B-G:1), WB=0.01/1.00 (C-F:1), SSI=0.05/1.00 (B-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.09 (B) (INPUT = 0.90)
JSI METAL = 0.02 (B) (INPUT = 1.00)




Structural component only
DWG# T-2008004

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	J1	6	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:20 2020 Page 1

ID:DMCubINVR6TstFoe31v6f_zns1l-sZm2pp8o7VOZ?QZVqAkMsWznQ2ilLkPuJezk6zLafL

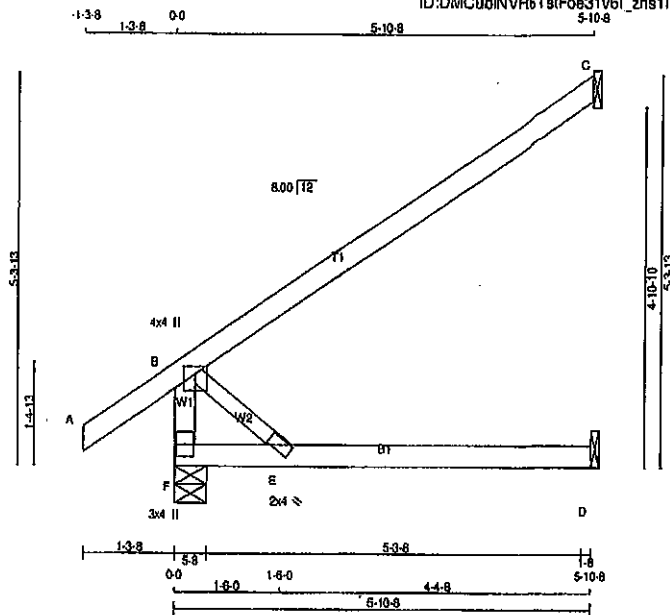

Scale = 1/28.0

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DRY
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)			
JT TYPE	PLATES	W	LEN Y X
B TMVW+p	MT20	4.0	4.0 1.25 2.00
E BMVW+w	MT20	2.0	4.0
F BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
F	450	0	450	0	0	5-8	5-8
C	270	0	270	0	0	1-8	1-8
D	54	0	81	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97781H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LOASE		MAX/MIN. COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE		WIND		DEAD		SOIL	
F	318	221/0	0/0	0/0	0/0	0/0	95/0	0/0	0/0	0/0	0/0
C	186	150/0	0/0	0/0	0/0	0/0	35/0	0/0	0/0	0/0	0/0
D	43	0/0	0/0	0/0	0/0	0/0	43/0	0/0	0/0	0/0	0/0

BEARING MATERIAL, TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CSI (LC)	MEMB.	FORCE (LBS)	MAX. FACTORED	CSI (LC)
FR-TO		FROM	TO	FR-TO			
F-B	-385/0	0.0	0.0 0.04 (1)	B-E	0/0	0.00 (1)	
A-B	0/35	-91.8	-91.8 0.12 (1)				
B-C	0/0	-91.8	-91.8 0.54 (1)				
F-E	0/0	-18.5	-18.5 0.14 (4)				
E-D	0/0	-18.5	-18.5 0.19 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.8	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 8, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BOBC 2018, OBC 2012, ABC 2019
- PART 8 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, GSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.05")

CSI: TC=0.54/1.00 (B-C:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION	(PSI)	(PLI)	(PLI)
MAX MIN MAX MIN MAX MIN			
MT20	618	354	1687
	788	1687	1655

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.28 (8) (INPUT = 0.90)
JSI METAL=0.08 (8) (INPUT = 1.00)




Structural component only
DWG# T-2007997

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408315	J2	8	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:22 2020 Page 1
ID:DMCubINVR6TstFoe31v61_zns11-oxupEV73i7eHzJ_ydFCCRHCpDDICLFEId74p7zLafJ

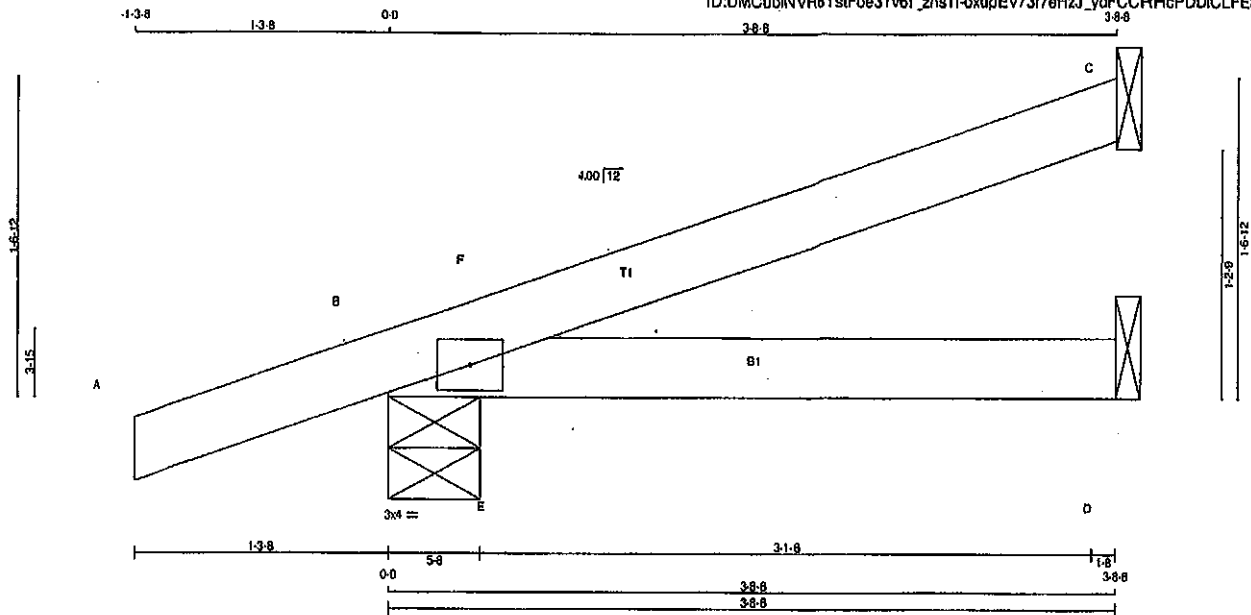

Scale = 1:10

TOTAL WEIGHT = 8 X 10 = 83 lb

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES	A - C	2x4	DRY	No.2	SPF
	B - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
	B	TMS1-1	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
C	146	0	146	0	1-8	1-8
B	327	0	327	0	5-8	5-8
D	58	0	58	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
C	101	78/0	0/0	0/0	0/0	23/0	0/0
B	229	163/0	0/0	0/0	0/0	66/0	0/0
D	43	17/0	0/0	0/0	0/0	27/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (6)

CHORDS					WEBS		
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO	FR-TO			
A-B	0/18	-91.8	-91.8 0.13 (5)	10.00	E-F	-146/6	0.00 (1)
B-F	-11/0	-91.8	-91.8 0.04 (4)	8.25			
F-C	0/2	-91.8	-91.8 0.16 (1)	10.00			
B-E	0/0	-18.5	-18.5 0.12 (1)	10.00			
E-D	0/0	-18.5	-18.5 0.12 (1)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $U/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $U/999$ (0.02")

CSI: TC=0.16/1.00 (C-F:1), BC=0.12/1.00 (B-E:1),
WB=0.00/1.00 (E-F:1), SS=0.12/1.00 (B-E:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	618	354	1887

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007998

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408316	J30	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:05:21 2020 Page 1

ID:DMCubINVR6TstFoe3iv8l_zns1i-bDbdAio2TcXz4(MqZ_I MaGYpB9fTbR7qDMZUJzLa9S

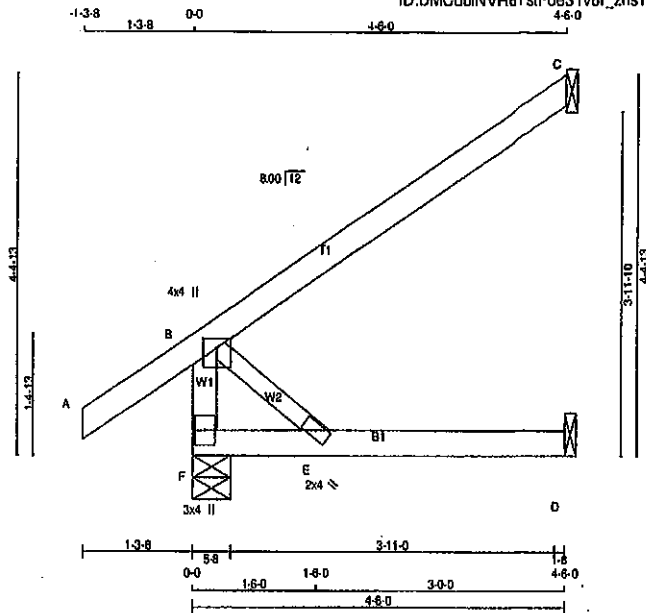

Scale = 1/24'

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF		
A - C	2x4	DRY	No.2	SPF		
F - D	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
DRY: SEASONED LUMBER.						

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	HORZ	DOWN	HORZ	UPLIFT
F	374	0	374	0
C	206	0	206	0
D	42	0	42	0

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	282	185 / 0	0 / 0	0 / 0	0 / 0	77 / 0	0 / 0
C	142	115 / 0	0 / 0	0 / 0	0 / 0	27 / 0	0 / 0
D	33	0 / 0	0 / 0	0 / 0	0 / 0	33 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally-RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED	MAX
MEMB.	FORCE	FORCE	FORCE	FORCE	FORCE	FORCE	FORCE	FORCE	FORCE
FR-TO	FR-TO	FR-TO	FR-TO	FR-TO	FR-TO	FR-TO	FR-TO	FR-TO	FR-TO
F-B	-332 / 0	0.0	0.0	0.03 (1)	7.81	8-E	0 / 0	0.00 (1)	
A-B	0 / 35	-81.8	-81.8	0.12 (1)	10.00				
B-C	0 / 0	-81.8	-81.8	0.32 (1)	10.00				
F-E	0 / 0	-18.5	-18.5	0.10 (4)	10.00				
E-D	0 / 0	-18.5	-18.5	0.11 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.10")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/380 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.32/1.00 (B-C:1), BC=0.11/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	518	354
	1887	789
	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.23 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008026

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	C1	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

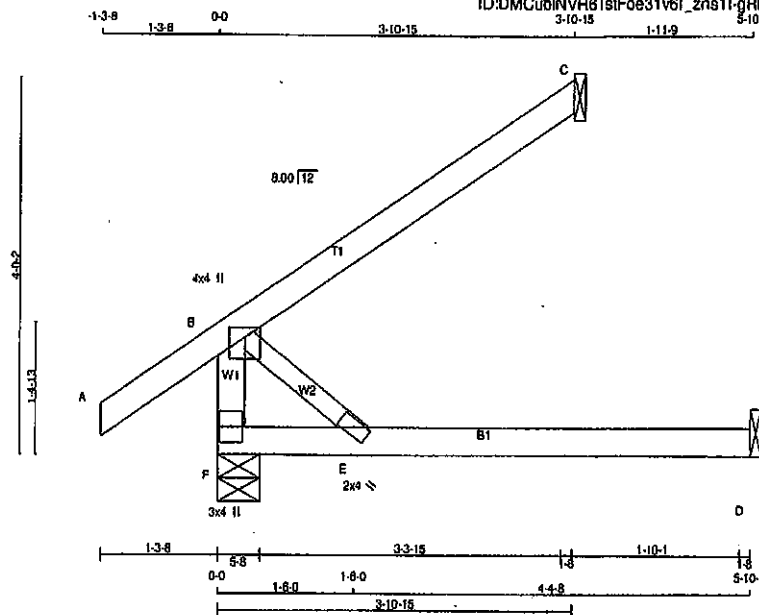

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES	F - B	2x4	DRY	No.2	SPF
	A - C	2x4	DRY	No.2	SPF
	F - D	2x4	DRY	No.2	SPF
	ALL WEBS	2x3	DRY	No.2	SPF
	DRY: SEASONED LUMBER.				

PLATES (table in inches)	W	LEN	Y	X
JT TYPE	MT20	4.0	4.0	1.25 2.00
B TMVW+p	MT20	2.0	4.0	
E BMVW+p	MT20	3.0	4.0	
F BMVW+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	IN-SX	IN-SX
F	380	380	0	5-8
C	179	179	0	1-8
D	54	61	0	1-8

SEE MITK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS	1ST CASE	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
JT	COMBINED						
F	254	170/0	0/0	0/0	0/0	83/0	0/0
C	124	100/0	0/0	0/0	0/0	23/0	0/0
D	43	0/0	0/0	0/0	0/0	43/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. MAX. (LC) UNBRACED LENGTH	MEMB.	FORCE (LBS)
FR-TO		FROM TO		FR-TO	
F-B	-305/0	0.0 0.0 0.03 (1)	7.81	B-E	0/0 0.00 (1)
A-B	0/35	-91.8 -91.8 0.12 (1)	10.00		
B-C	0/0	-91.8 -91.8 0.24 (1)	10.00		
F-E	0/0	-18.5 -18.5 0.14 (4)	10.00		
E-D	0/0	-18.5 -18.5 0.19 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 086-14
- TFC 2011, TFC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TO=0.24/1.00 (B-C:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 Inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.21 (B) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007989

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	C2	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:10 2020 Page 1	

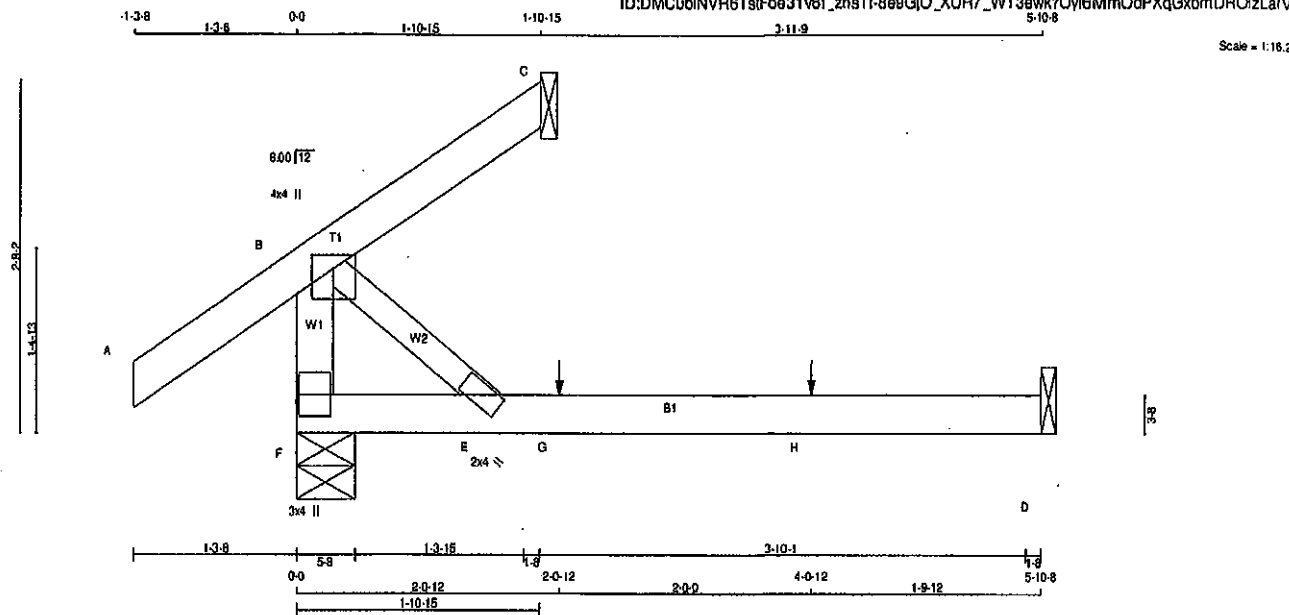

TOTAL WEIGHT = 14 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF		
A - C	2x4	DRY	No.2	SPF		
F - D	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
DRY: SEASONED LUMBER.						

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.25	2.00	
E BMVW+p	MT20	2.0	4.0			
F BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
JT. VERT	HORZ	DOWN	HORZ	UPLIFT
IN-SX	IN-SX	IN-SX	IN-SX	IN-SX
F	313	0	313	0
C	42	0	42	0
D	54	0	54	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) F, C

UNFACTORED REACTIONS

JT	1ST LOSE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	222	144 / 0	0 / 0	0 / 0	0 / 0	77 / 0	0 / 0	0 / 0
C	29	24 / 0	0 / 0	0 / 0	0 / 0	6 / 0	0 / 0	0 / 0
D	43	0 / 0	0 / 0	0 / 0	0 / 0	43 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MAX. UNBRAC (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO	LENGTH	FR-TO		
F-B	-259 / 0	0.0	0.0	0.03 (1)	7.81	0 / 0	0.00 (1)
A-B	0 / 35	-18.5	-18.5	0.13 (1)	10.00		
B-C	-25 / 0	-18.5	-18.5	0.12 (1)	8.25		
F-E	0 / 0	-18.5	-18.5	0.14 (4)	10.00		
E-G	0 / 0	-18.5	-18.5	0.19 (4)	10.00		
G-H	0 / 0	-18.5	-18.5	0.19 (4)	10.00		
H-D	0 / 0	-18.5	-18.5	0.19 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
G	2-0-12	1	1	---	FRONT	VERT	TOTAL	---	C1
H	4-0-12	1	1	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 8 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSI: TC=0.13/1.00 (A-B:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SI=0.00/1.00 (B-C:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	(PL)
MAX	MIN	MAX	MIN
MT20	818	354	1587
	788	1587	1556

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.18 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007990

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408315	C3	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:12 2020 Page 1

ID:DMCubINV6TstFoe31v6l_zns1f-50H184?n02NlmmD1191s1ABgUCLV?KE23tYSazLafT

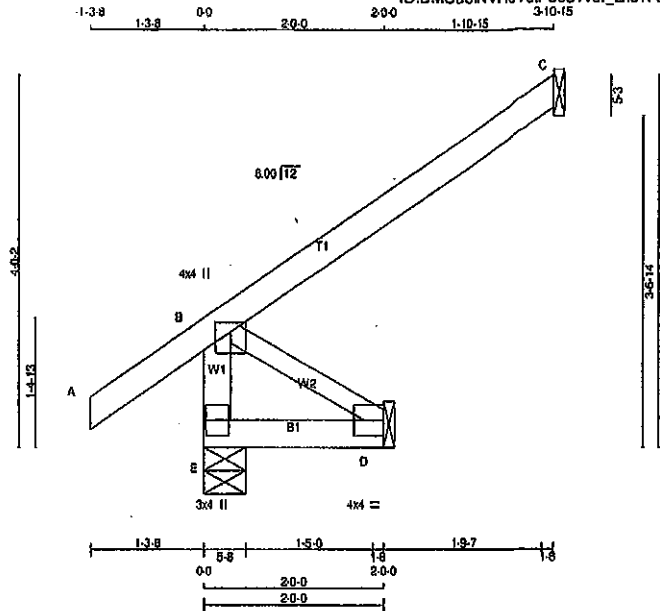

Scale = 1:23.0

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY; SEASONED LUMBER.					

PLATE	(table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00		
D	BMV1-t	MT20	4.0	4.0	2.00	Edge		
E	BMV1+p	MT20	3.0	4.0				

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED			INPUT	REQD
GROSS REACTION		GROSS REACTION	BRG			BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	323	0	323	0	0	5-8	5-8
C	179	0	179	0	0	1-8	1-8
D	18	0	20	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	224	170 / 0	0 / 0	0 / 0	0 / 0	54 / 0	0 / 0
C	124	100 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0
D	14	0 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH FR-TO	MEMB.	FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO					
E-B	305 / 0	0.0 0.0	0.03 (1)	7.81	B-D	0 / 0	0.00 (1)
A-B	0 / 35	-91.8 -91.8	0.13 (5)	10.00			
B-C	0 / 0	-91.8 -91.8	0.24 (1)	10.00			
E-D	0 / 0	-18.5 -18.5	0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCG 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.24/1.00 (B-C:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (B-D:1), SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1887 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.21 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007991

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	C4	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 09:31:13 2020 Page 1
ID:DMCubINVR6TslFoe3iv6l_zns1l-ZCrPLQOPnMVZNwoDbsY5aCkt1bhkkB7NHjSS_0zLatS
1-10-15 2:00

Scale = 1:16.2

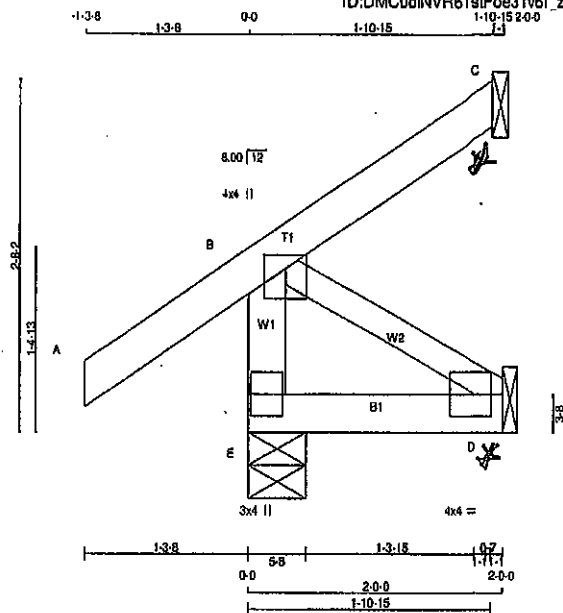

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
D	BMV1-t	MT20	4.0	4.0	2.00 1.50
E	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	BRG	IN-SX	BRG	IN-SX
E	276	0	276	0	0	5-8	5-8	5-8	5-8
C	42	0	42	0	-35	1-8	1-8	1-8	1-8
D	18	0	20	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
E	192	144 / 0	0 / 0	0 / 0	0 / 0	48 / 0	0 / 0
C	28	24 / 25	0 / 0	0 / 0	0 / 0	8 / 0	0 / 0
D	14	0 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		WEBS	
MEMB.	MAX. FACTORED	MEMB.	MAX. FACTORED
	FORCE (LBS)		FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
E-B	-259 / 0	0.0	0.0
A-B	0 / 35	-91.8	-91.8
B-C	-25 / 0	-91.8	-91.8
E-D	0 / 0	-18.5	-18.5

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL) = L/360 (0.19")

CALCULATED VERT. DEFL.(TL) = 1.999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (B-D:1), SSI=0.09/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1687

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.18 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007992

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408317	C51	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 3 Oct 2019 Mitek Industries, Inc. Thu Apr 30 10:50:26 2020 Page 1
ID:DMCubiNVR8TstFoe31v6l_zns1l-ucXEuYoRjK96MfiXaJhii47bZrulpf_EJ6JtZLZVB

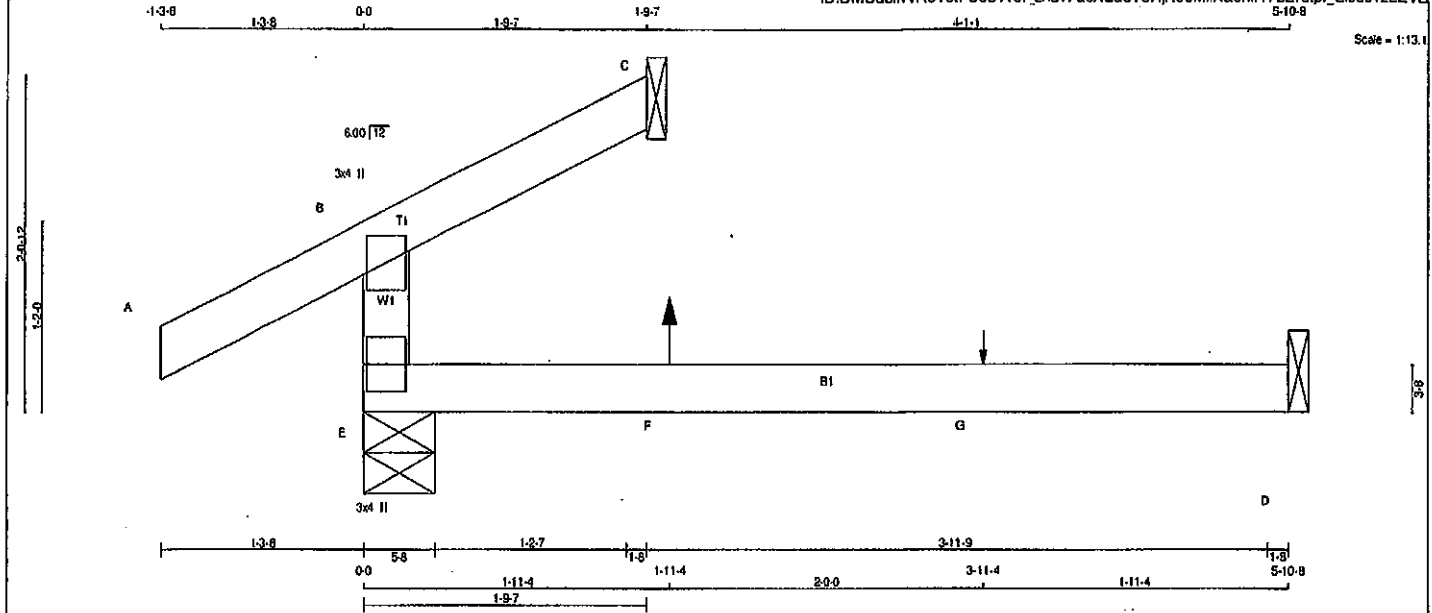

TOTAL WEIGHT = 4 X 12 = 48 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED	MAXIMUM FACTORED	INPUT	REQD			
	GROSS REACTION	GROSS REACTION	BRG	BRG			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	284	0	284	0	0	5-8	5-8
C	63	0	63	0	0	1-8	1-8
D	44	0	52	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97781H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	200	137.0	0.0	0.0	0.0	62.0	0.0
C	46	21.0	0.0	0.0	0.0	25.0	0.0
D	35	0.3	0.0	0.0	0.0	37.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (7)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM	TO	FR-TO			
E-B	227.0	0.0	0.0 0.11 (4)	7.81			
A-B	0.28	-91.8	-91.8 0.12 (1)	10.00			
B-C	-9.19	-91.8	-91.8 0.08 (4)	10.00			
E-F	0.0	-18.5	-18.5 0.14 (4)	10.00			
F-G	0.0	-18.5	-18.5 0.14 (4)	10.00			
G-D	0.0	-18.5	-18.5 0.14 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
F	1-11-4	7	1	12	BACK	VERT	TOTAL
G	3-11-4	1	1	---	BACK	VERT	TOTAL

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=0.99 NAIL=0.99 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2008051

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408317	C52	4	1	TRUSS DESC.		

Tamareck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:28 2020 Page 1

ID:DMCubINVR6TsfFoe31v6I_zns11-Mo5c6_YRC1S0jWEu5HwFvdGkzD0cGv7SM2fsSzLZVA

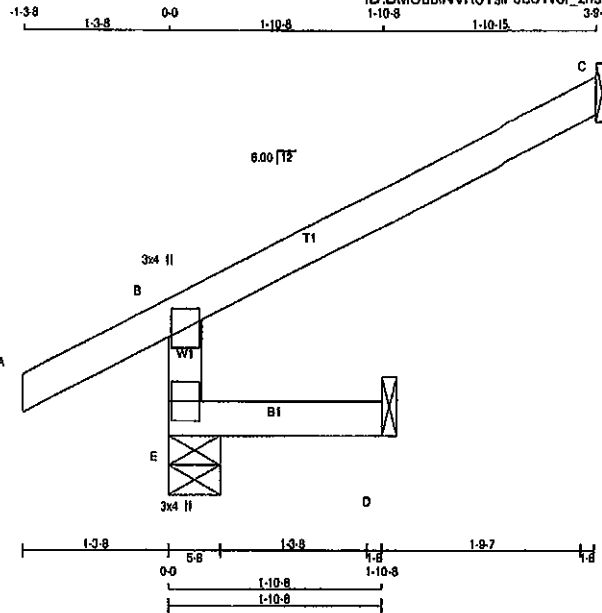

Scale = 1/16"

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	BRG	IN-SX	BRG	IN-SX
E	381	0	381	0	0	5-8	5-8	5-8	5-8
C	130	0	130	0	0	1-8	1-8	1-8	1-8
D	18	0	17	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST LCASE		MAX. MIN. COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	DEAD	SOIL	DEAD	SOIL
E	250	180/0	0/0	0/0	0/0	80/0	0/0	80/0	0/0	0/0	0/0
C	90	73/0	0/0	0/0	0/0	17/0	0/0	17/0	0/0	0/0	0/0
D	12	0/0	0/0	0/0	0/0	12/0	0/0	12/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS		FACTORED		W E B S		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX (PLF)	CS1 (LC)	UNBRAC LENGTH	MEMB.	FORCE (LBS)
FR-TO						FR-TO	
E-B	-342/0	0.0	0.0	0.01 (4)	7.81	E-B	-342/0
A-B	0/28	-91.8	-91.8	0.13 (5)	10.00	A-B	0/28
B-C	-19/0	-91.8	-91.8	0.22 (1)	8.25	B-C	-19/0
E-D	0/0	-18.5	-18.5	0.02 (4)	10.00	E-D	0/0

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CS1: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (W/A:0), SS1=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1887
	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.14 (E) (INPUT = 0.80)
JSI METAL=0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008052

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:50:29 2020 Page 1
ID:DMCubiNVR6TstFoe31v8| zns11-IBDMXfahkeikzqNHCiiOKKiesm94AOQwgXmwMzLVz8



TOTAL WEIGHT = 4 X 7 = 28 lb

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)



LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.


Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1 1/4" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options Information on p. 126.

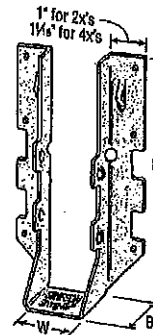


LUS28




LU26L

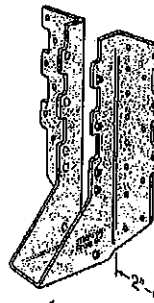

HUS210
(HUS26, HUS28,
and HHUS similar)



HGUS28-2



HHUS210-2



Double-Shear
Nailing
Top View





Double-Shear
Nailing
Side View;
Do not
bend tab



Dome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,803,580

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

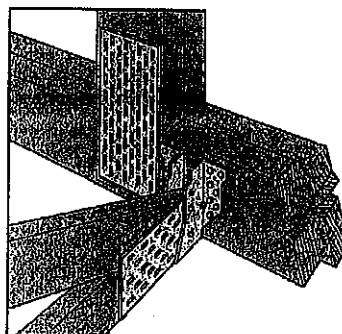

LJS26DS

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**SIMPSON**
Strong-Tie**HHUS/HGUS**

See Hanger Options information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value

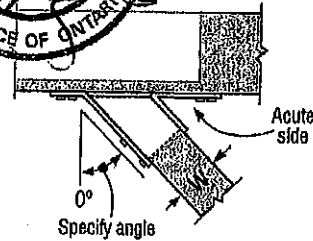

Top View HHUS Hanger Skewed Right
(joist must be bevel cut)
All joist nails installed on the outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)					Fasteners		Factored Resistance			
		W	H	B	d _a ³	Header	Joist		D-Fir-L		S-P-F	
									Uplift	Normal	Uplift	Normal
									(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
									lb.	lb.	lb.	lb.
									kN	kN	kN	kN
Single 2x Sizes												
LUS24	18	1 1/8	3 1/4	1 1/4	2 1/4	(4) 10d	(2) 10d		710	1625	645	1155
									3.16	7.23	2.87	5.14
LU24L	22	1 1/8	3	1 1/8	2 1/8	(4) 10d	(2) 10d x 1 1/2"		360	1020	320	725
									1.60	4.54	1.42	3.22
LU28L	22	1 1/8	5	1 1/8	4 1/8	(6) 10d	(4) 10d x 1 1/2"		720	1605	645	1140
									3.20	7.14	2.87	5.07
SS LUS26	18	1 1/8	4 1/4	1 1/4	3 3/4	(4) 10d	(4) 10d		1420	2170	1290	1630
									6.32	9.85	5.74	7.25
HUS28	18	1 1/8	6 1/4	3	3 3/8	(14) 18d	(6) 18d		2705	4940	2065	3875
									11.80	21.97	9.20	17.24
LJS26DS	18	1 1/8	5	3 1/2	4 1/8	(16) 16d	(6) 16d		2055	4265	1480	4115
									9.14	18.97	6.49	18.31
HGUS28	12	1 1/8	5 1/8	5	4 1/8	(20) 18d	(8) 18d		2885	6625	2685	5700
									11.88	29.51	11.96	25.35
LU28L	20	1 1/8	6 1/4	1 1/8	5 1/8	(8) 10d	(6) 10d x 1 1/2"		1140	2185	1020	1550
									5.07	9.72	4.54	6.89
SS LUS28	18	1 1/8	6 1/8	1 1/4	3 3/4	(8) 10d	(4) 10d		1420	2520	1290	1790
									6.32	11.21	5.74	7.98
HUS28	16	1 1/8	7 1/8	3	6 1/8	(22) 18d	(8) 18d		3805	5366	2675	4345
									16.94	23.88	11.90	19.33
HGUS28	12	1 1/8	7 1/8	5	6 1/8	(36) 18d	(12) 16d		3310	7675	3310	6900
									14.74	34.19	14.74	30.73
LU210L	20	1 1/8	8	1 1/8	7 1/8	(10) 10d	(6) 10d x 1 1/2"		1140	2495	1020	1770
									5.07	11.10	4.54	7.87
SS LUS210	18	1 1/8	7 1/8	1 1/4	3 3/4	(8) 10d	(4) 10d		1420	2785	1290	2210
									6.32	12.39	5.74	9.83

1. Factored uplift resistances have been increased 16% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_a is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.


Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive[®] SD Connector screw. See pp. 32-34 for more information.

SIMPSON
Strong-Tie

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _o ³	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb.	(K _D = 1.00) lb.	(K _D = 1.15) lb.	(K _D = 1.00) lb.
								kN	kN	kN	kN
Double 2x Sizes											
LUS24-2	18	3 1/8	3 1/8	2	1 1/2	(4) 16d	(2) 16d	835	2020	590	1435
LUS26-2	18	3 1/8	4 3/8	2	4	(4) 16d	(4) 16d	3.71	8.98	2.62	6.38
HHUS26-2	14	3 1/8	5 3/8	3	3 1/4	(14) 16d	(6) 16d	1720	2595	1545	1920
HGUS26-2	12	3 1/8	5 3/8	4	4 1/4	(20) 16d	(8) 16d	7.65	11.54	6.87	8.54
LUS28-2	18	3 1/8	7	2	4	(6) 16d	(4) 16d	2850	7335	2065	5205
HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	12.68	32.63	9.20	23.15
HGUS28-2	12	3 1/8	7 3/8	4	8 1/4	(36) 16d	(12) 16d	4385	8950	3110	6355
LUS210-2	18	3 1/8	9	2	6	(8) 16d	(8) 16d	19.51	39.81	13.83	28.27
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d	1720	3325	1545	2575
HGUS210-2	12	3 1/8	9 1/8	4	8 1/4	(46) 16d	(16) 16d	7.65	14.79	6.87	11.45
								3765	8940	2675	6345
								16.75	39.77	11.90	28.22
								6070	12980	4310	9215
								27.00	57.74	19.17	40.99
LUS210-2	18	3 1/8	9	2	6	(8) 16d	(8) 16d	2680	4500	2320	3195
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d	11.48	20.02	10.32	14.21
HGUS210-2	12	3 1/8	9 1/8	4	8 1/4	(46) 16d	(16) 16d	4670	9660	4235	7000
								20.77	42.97	18.84	31.14
								6840	14015	4855	10270
								30.43	62.34	21.60	45.69
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/8	4	4 1/4	(20) 16d	(8) 16d	4385	8950	3110	6355
HGUS28-3	12	4 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	19.51	39.81	13.83	28.27
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	6070	12980	4310	9215
HGUS210-3	12	4 1/8	9 1/4	4	8 1/4	(46) 16d	(16) 16d	27.00	57.74	19.17	40.99
								4670	9670	4235	6855
								20.77	43.02	19.84	30.54
								6840	14645	4855	10400
								30.43	65.14	21.60	46.26
Quadruple 2x Sizes											
HGUS26-4	12	6 1/8	5 1/8	4	4 1/4	(20) 16d	(8) 16d	4385	8950	3110	6355
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	19.51	39.81	13.83	28.27
HHUS210-4	14	6 1/8	8 1/8	3	7 1/8	(30) 16d	(10) 16d	6070	12980	4310	9215
HGUS210-4	12	6 1/8	9 1/8	4	8 1/4	(46) 16d	(16) 16d	27.00	57.74	19.17	40.99
								4670	10155	4235	7210
								20.77	45.17	18.84	32.07
								6840	14645	4855	10400
								30.43	65.14	21.60	46.26
HGUS212-4	12	6 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10645
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	33.98	66.70	24.13	47.35
								10130	16400	7195	11645
								45.06	72.95	32.00	61.80
4x Sizes											
LUS46	18	3 1/8	4 3/8	2	3 1/8	(4) 16d	(4) 16d	1720	2595	1545	1920
HHUS46	14	3 1/8	5 1/8	3	3 1/4	(14) 16d	(6) 16d	7.65	11.54	6.87	8.54
HGUS46	12	3 1/8	5 1/8	4	4 1/4	(20) 16d	(8) 16d	2540	7335	2065	5205
LUS48	18	3 1/8	6 3/8	2	3 1/8	(6) 16d	(4) 16d	11.30	32.63	9.20	23.15
HHUS48	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	4385	8950	3110	6355
HGUS48	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	19.51	39.81	13.83	28.27
LUS410	18	3 1/8	8 3/8	2	5 1/8	(8) 16d	(8) 16d	1720	3325	1545	2575
HHUS410	14	3 1/8	9 1/8	3	8 1/8	(30) 16d	(10) 16d	7.65	14.79	6.87	11.45
HGUS410	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	3765	8940	2675	6345
LUS412	18	3 1/8	10 3/8	2	6 1/8	(10) 16d	(10) 16d	16.75	39.77	11.90	28.22
HGUS412	12	3 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	6070	12980	4310	9215
LUS414	18	3 1/8	12 3/8	2	7 1/8	(12) 16d	(12) 16d	27.00	57.74	19.17	40.99
HGUS414	12	3 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
								6840	14015	4855	10270
								30.43	62.34	21.60	45.69
								7640	14995	5425	10645
								33.98	66.70	24.13	47.35
								10130	16400	7195	11645
								45.06	72.95	32.00	61.80



Plated Truss Connectors

See footnotes
on p. 268.

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

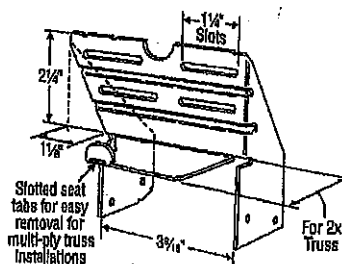


TC24
U.S. Patent 4,932,173

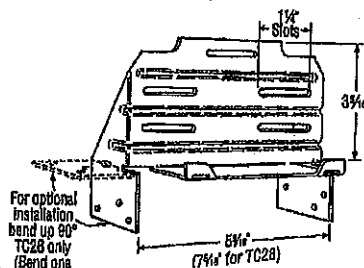


TC28
(TC28 Similar)

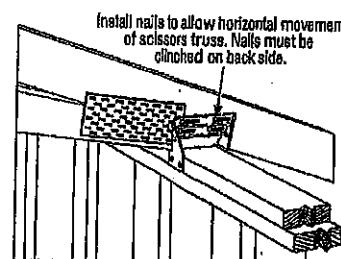

Typical TC24 Installation

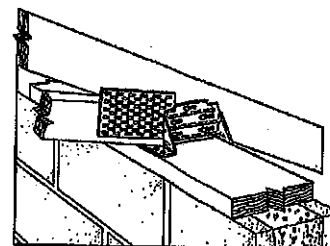

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer (8", 10", 12" Wall Installation Similar)

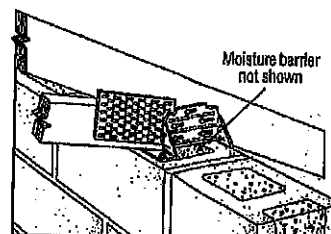

Optional TC28 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L Uplift ($K_F=1.15$)	S-P-F Uplift ($K_F=1.15$)
			lb.	lb.
TC24	(4) 10d	(4) 10d	605	430
TC26	(6) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L Uplift ($K_F=1.15$)	S-P-F Uplift ($K_F=1.15$)
			lb.	lb.
TC26	(5) 10d	(6) 10d x 1 1/2"	810	660
	(5) 10d	(6) 10d	930	680

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC28 installation with 10d nails requires minimum 3" top plate thickness.
4. TC28 fastened to grouted concrete block with (6) - 3/8" x 2 1/4" Titen screws has a factored uplift resistance of 275 lb.



DESIGN

(800) 999-5099
strongtie.com

H/TSP

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Gr.	Fasteners			Factored Resistance ($K_D = 1.15$)					
					D.Fir-L			S-P-F		
		To Rafters/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(6) 8d x 1½"	(4) 8d	—	740	685	300	680	485	215
					3.29	3.05	1.33	3.02	2.16	0.98
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
					3.58	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	180	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	285	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ³	18	(5) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A ⁹	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	585	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^{7,8}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1465	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
		[2] (12) 8d x 1½"	(15) 8d	—	10.83	3.80	1.42	8.03	2.71	1.02
					2390	855	320	1805	610	230
					10.83	3.80	1.42	8.03	2.71	1.02
TSP	16	(9) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
					5.76	1.96	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.98	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.76. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (6) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.162" dia, x 2½" long, 10d = 0.148" dia, x 3" long, 10d x 1½" = 0.148" dia, x 1½" long, 8d = 0.131" dia, x 2½" long, 8d x 1½" = 0.131" dia, x 1½" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

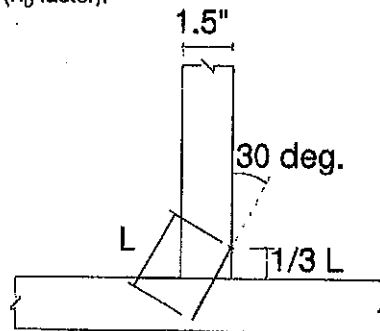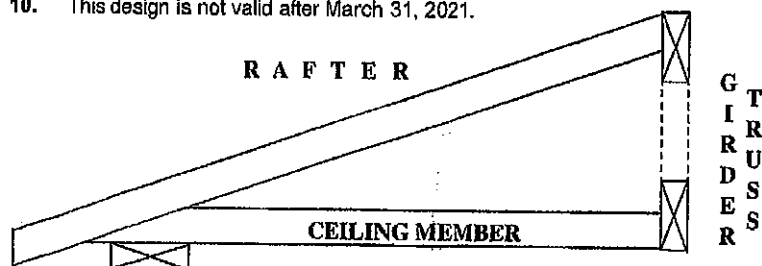

TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (In)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to wind or earthquake load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

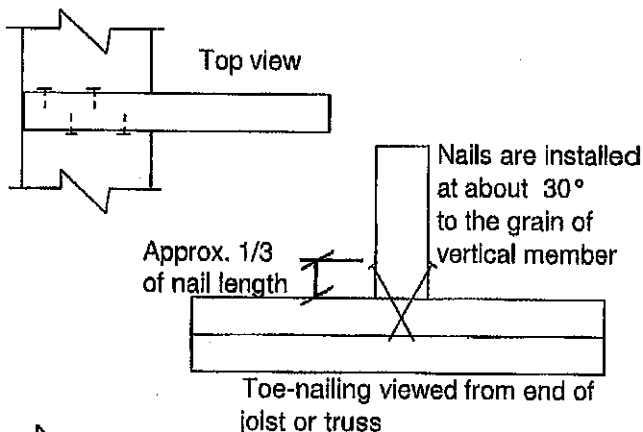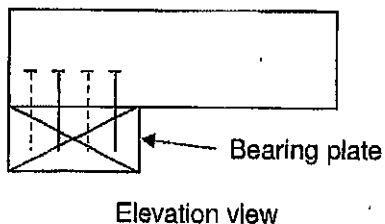

Toe-nailing on 2x4 Bearing Plate

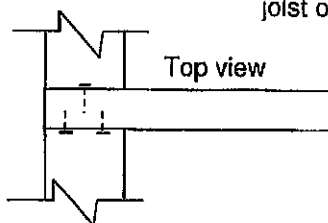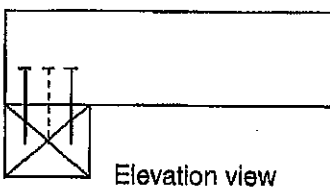

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7


PEO
Certificate No. 10889485




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint, unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/8" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.

Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

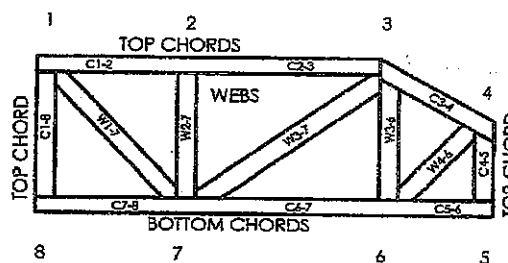

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L 10319-L 13270-L 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MIL-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing of 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

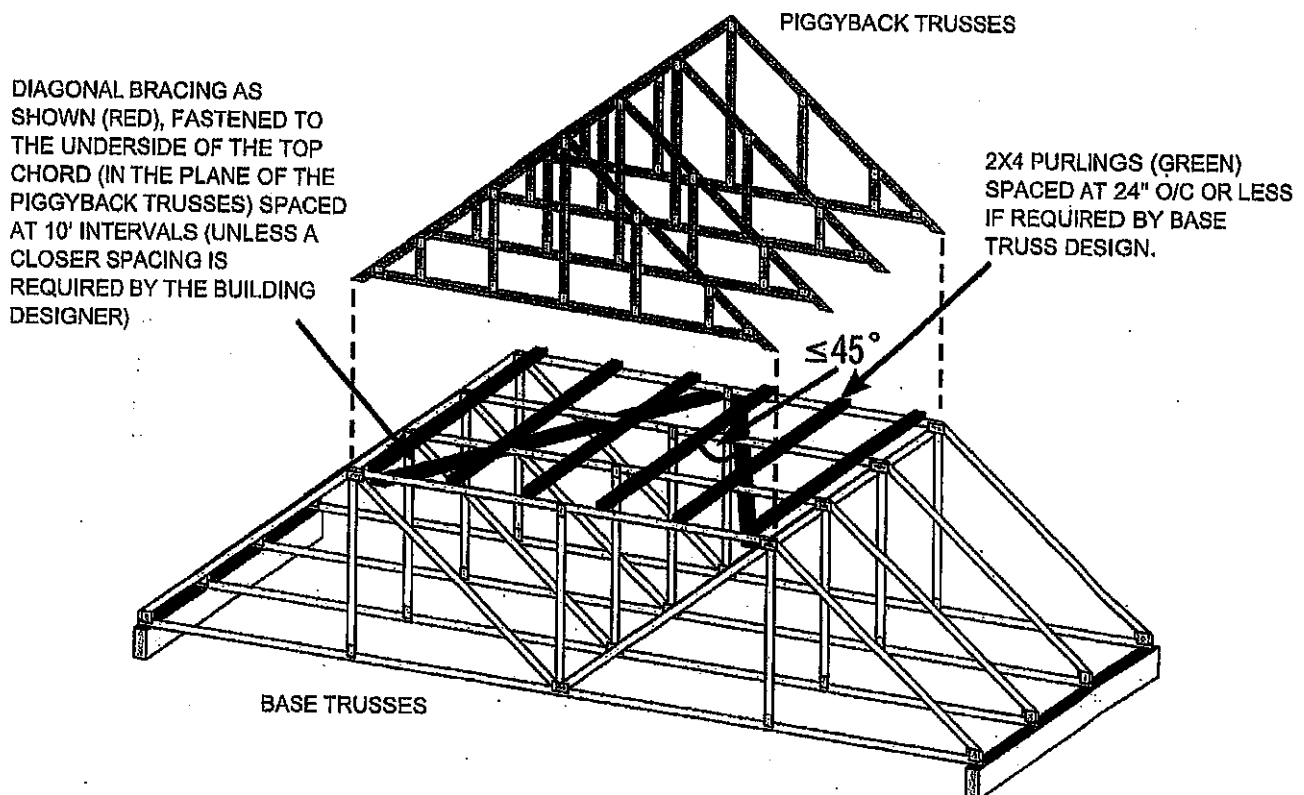

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note is not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1900215

Feb 09, 2018