



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 5
 Lot #: 258
 Elevation: 1- STD OR OPT.5 BR


Job Track: 51225
 PlanLog: 202406
 Layout ID: 408168
 Ref #
 Page: 1 of 2
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	10/12	35-02-00	4-01-11	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	385.29 218.00		
	1 2-ply	T1Z Hip Girder	10/12	35-02-00	4-01-11	2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	385.29 218.00		
	2	T2 Hip	10/12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	293.44 185.67		
	2	T3 Hip	10/12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	296.43 188.67		
	2	T4 Hip	10/12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	323.09 204.33		
	2	T5 Hip	10/12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	326.19 204.67		
	2	T6 Hip	10/12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	363.03 228.67		
	5	T7 Hip	10/12	35-02-00	10-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	886.6 540.00		
	2	T8 Hip	10/12	35-02-00	11-01-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	380.36 238.67		
	6	T9 Common	10/12	16-03-00	8-04-15	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	480.92 308.00		
	1	G9 GABLE	10/12	16-03-00	8-04-15	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	81.49 53.33		
	1	T10 Common	10/12	8-02-00	5-00-08	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	38.47 25.83		
	1	G10 GABLE	10/12	8-02-00	5-00-08	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	40.07 27.83		
	3	T11 Common	10/12	13-05-00	7-02-12	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	191.27 120.50		

 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 5 Lot #: 258 Elevation: 1- STD OR OPT.5 BR	Job Track: 51225 PlanLog: 202406 Layout ID: 408168 Ref # Page: 2 of 2 Date: 04-27-2020 Designer: Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	G11 GABLE	10 /12	13-05-00	7-02-12	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	66.46 42.17		
	1	T12 Hip Girder	10 /12	8-02-00	2-02-08	2 x 4	1-03-08 1-03-08	1-00-07 1-00-07	34.43 25.33		
	1	T13 Half Hip Girder	10 /12	7-07-00	2-02-08	2 x 4	1-03-08	1-00-07 1-09-07	31.77 22.50		
	3	PB1 Piggyback	10 /12	14-10-03	2-00-00	2 x 4			135.57 90.00		
	19	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	319.1 202.87		
	8	J2 Jack-Open	4 /12	4-04-08	2-02-06	2 x 4	1-03-08	3-15 1-09-07	95.29 64.00		


TOTAL # TRUSS= 66 TOTAL BFT OF ALL TRUSSES= 3206.84 BFT. TOTAL WEIGHT OF ALL TRSSES 5093.55 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS26-2	
5	Hardware	LJS26DS	
1	Hardware	LUS26-2	

TOTAL NUMBER OF
ITEMS= 7

JOB NAME 408168	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Sat Apr 25 12:34:48 2020 Page 1	

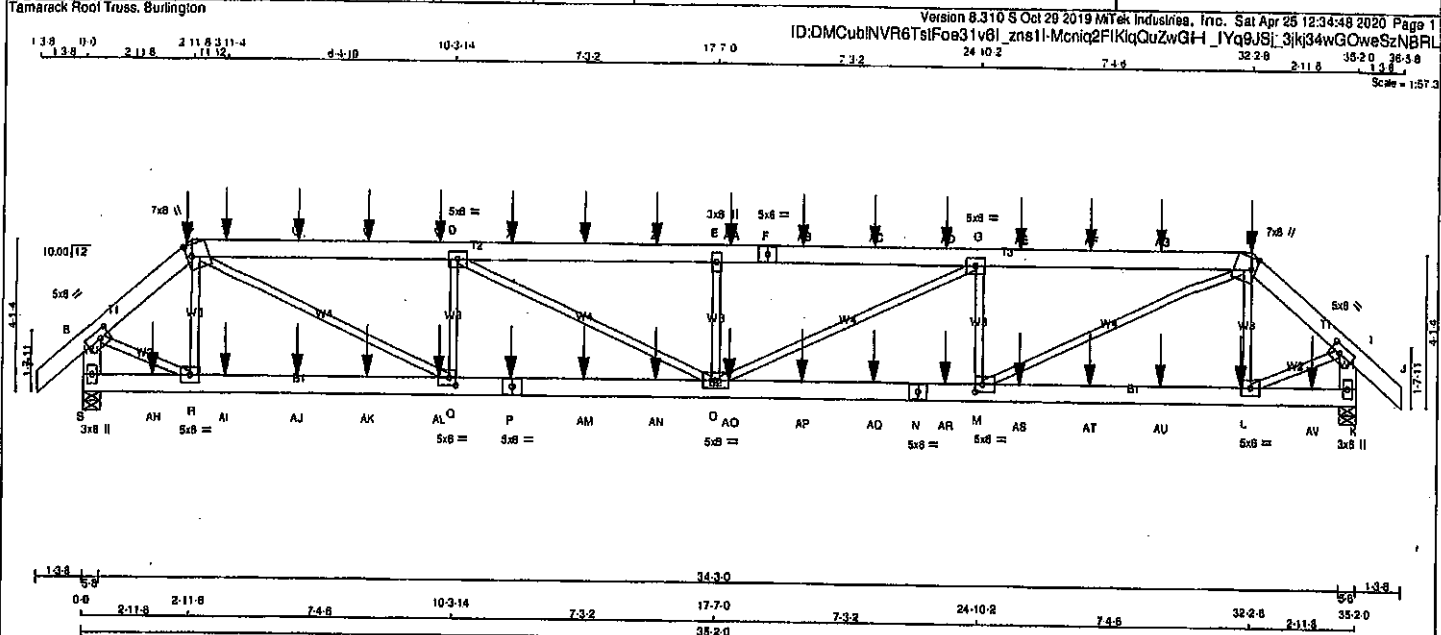

LUMBER			
N.L.G.A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x8	DRY No.2	SPF
C - F	2x8	DRY No.2	SPF
F - H	2x8	DRY No.2	SPF
H - J	2x8	DRY No.2	SPF
J - L	2x8	DRY No.2	SPF
L - N	2x8	DRY No.2	SPF
N - K	2x8	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS SURFACE SPACING (IN) LOAD (PLF)

TOP CHORDS : (0.122"x3") SPIRAL NAILS

A-C 2 12 SIDE(122.0)

C-F 2 12 SIDE(81.0)

F-H 2 12 SIDE(81.0)

H-J 2 12 SIDE(122.0)

J-L 2 12 TOP

L-N 2 12 TOP

N-K 2 12 TOP

BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS

S-P 2 12 SIDE(0.0)

P-N 2 12 SIDE(0.0)

N-K 2 12 SIDE(197.0)

WEBS : (0.122"x3") SPIRAL NAILS

2x3 1 6

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
	FACTORED	MAXIMUM FACTORED	INPUT	REQD			
JT	GROSS REACTION	GROSS REACTION	8RG	8RG			
S	VERY	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
S	3350	0	3350	0	5-8	5-8	
K	3379	0	3379	0	5-8	5-8	

UNFACTORED REACTIONS							
1ST LOASE	MAX/MIN	COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	2354	1553 / 0	0 / 0	0 / 0	0 / 0	801 / 0	0 / 0
K	2388	1572 / 0	0 / 0	0 / 0	0 / 0	816 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.98 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING							
TOTAL LOAD CASES: (4)							
CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO				FR-TO			
A-B	0 / 42	-91.8	-91.8 0.04 (1)	10.00	R-C	-650 / 0	0.08 (1)
B-C	-3397 / 0	-91.8	-91.8 0.05 (1)	6.02	C-Q	0 / 4509	0.56 (1)
C-T	-8602 / 0	-91.8	-91.8 0.38 (1)	4.31	Q-D	-1789 / 0	0.22 (1)
T-U	-8602 / 0	-91.8	-91.8 0.38 (1)	4.31	D-O	0 / 1370	0.17 (1)
U-V	-8602 / 0	-91.8	-91.8 0.38 (1)	4.31	O-E	-987 / 0	0.12 (1)
V-W	-8602 / 0	-91.8	-91.8 0.38 (1)	4.31	E-G	0 / 1382	0.17 (1)
W-D	-8602 / 0	-91.8	-91.8 0.38 (1)	4.31	M-H	-1787 / 0	0.21 (1)
D-X	-7828 / 0	-91.8	-91.8 0.42 (1)	3.98	M-H	0 / 4481	0.55 (1)
X-Y	-7828 / 0	-91.8	-91.8 0.42 (1)	3.98	L-H	-681 / 0	0.08 (1)
Y-Z	-7828 / 0	-91.8	-91.8 0.42 (1)	3.98	B-R	0 / 2736	0.34 (1)
Z-E	-7828 / 0	-91.8	-91.8 0.42 (1)	3.98	L-I	0 / 2771	0.34 (1)
E-AA	-7828 / 0	-91.8	-91.8 0.42 (1)	3.98			
AA-F	-7828 / 0	-91.8	-91.8 0.42 (1)	3.98			
F-AB	-7828 / 0	-91.8	-91.8 0.42 (1)	3.98			
AB-AC	-7828 / 0	-91.8	-91.8 0.42 (1)	3.98			
AC-AD	-7828 / 0	-91.8	-91.8 0.42 (1)	3.98			
AD-G	-7828 / 0	-91.8	-91.8 0.42 (1)	3.98			
G-AE	-6808 / 0	-91.8	-91.8 0.38 (1)	4.31			
AE-AF	-6808 / 0	-91.8	-91.8 0.38 (1)	4.31			
AF-AG	-6808 / 0	-91.8	-91.8 0.38 (1)	4.31			
AG-H	-6808 / 0	-91.8	-91.8 0.38 (1)	4.31			
H-I	-3410 / 0	-91.8	-91.8 0.05 (1)	6.00			
I-J	0 / 42	-91.8	-91.8 0.04 (1)	10.00			
S-B	-3375 / 0	0.0	0.0 0.12 (1)	7.58			
K-I	-3414 / 0	0.0	0.0 0.12 (1)	7.55			

S-AH	0 / 0	-18.5	-18.5 0.05 (4)	10.00
AH-R	0 / 0	-18.5	-18.5 0.05 (4)	10.00
R-AI	0 / 2553	-18.5	-18.5 0.12 (1)	10.00
AI-AJ	0 / 2553	-18.5	-18.5 0.12 (1)	10.00
AJ-AK	0 / 2553	-18.5	-18.5 0.12 (1)	10.00
AK-AL	0 / 2553	-18.5	-18.5 0.12 (1)	10.00
AL-Q	0 / 2553	-18.5	-18.5 0.12 (1)	10.00
Q-P	0 / 8802	-18.5	-18.5 0.22 (1)	10.00
P-AM	0 / 8802	-18.5	-18.5 0.22 (1)	10.00
AM-AN	0 / 8802	-18.5	-18.5 0.22 (1)	10.00
AN-O	0 / 8802	-18.5	-18.5 0.22 (1)	10.00
O-AO	0 / 8809	-18.5	-18.5 0.22 (1)	10.00
AO-AP	0 / 8809	-18.5	-18.5 0.22 (1)	10.00
AP-AQ	0 / 8809	-18.5	-18.5 0.22 (1)	10.00
AQ-N	0 / 8809	-18.5	-18.5 0.22 (1)	10.00
N-AR	0 / 8809	-18.5	-18.5 0.22 (1)	10.00
AR-M	0 / 8809	-18.5	-18.5 0.22 (1)	10.00

TOTAL WEIGHT = 2 X 183 = 366 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***

GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.

LOADS WERE DERIVED FROM USER INPUT

NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL DL = 39.0 PSF

SPACING = 24.0 IN. O.C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019

- PART 9 OF NBC 2012 (2019 AMENDMENT)

- CSA 088-09, CSA 088-14

- TPC 2011, TPC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17)

CALCULATED VERT. DEFL. (LL) = L/999 (0.20)

ALLOWABLE DEFL. (TL) = L/360 (1.17)

CALCULATED VERT. DEFL. (TL) = L/999 (0.37)

CSI: TC=0.42/1.00 (D-E:1), BC=0.22/1.00 (O-Q:1), WB=0.58/1.00 (C-Q:1), SSI=0.22/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 618 354 1687 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (H) (INPUT = 0.90)

JSI METAL = 0.85 (N) (INPUT = 1.00)

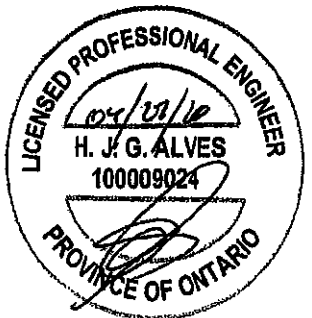

Structural component only

DWG# T-2007129 1/2

JOB NAME 408168	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:48 2020 Page 2	
				ID:DMCubINVR6TslFoe31v6I zns11-Menb2FIKlQQuZwGH IYq9JSI 3ik34wGOWeSzNBRI	

PLATES (inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-1	MT20	5.0	8.0	2.50 3.25
C	TTWW+m	MT20	7.0	8.0	3.75 1.50
D	TMVW-1	MT20	5.0	8.0	
E	TMVW-w	MT20	3.0	8.0	
F	TS-1	MT20	5.0	8.0	
G	TMVW-1	MT20	5.0	8.0	
H	TTWW+m	MT20	7.0	8.0	3.75 1.50
I	TMVW-1	MT20	5.0	8.0	2.50 3.25
K	BMV1+p	MT20	3.0	8.0	
L	BMVW-1	MT20	5.0	8.0	
M	BMVW-1	MT20	5.0	8.0	2.50 2.25
N	BS-1	MT20	5.0	8.0	
O	BMVW-1	MT20	5.0	8.0	
P	BS-1	MT20	5.0	8.0	
Q	BMVW-1	MT20	5.0	8.0	2.50 2.25
R	BMVW-1	MT20	5.0	8.0	
S	BMV1+p	MT20	3.0	8.0	

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		LENGTH		
M-AS	0/2588	-18.5	-18.5	0.12 (1)	10.00				
AS-AT	0/2588	-18.5	-18.5	0.12 (1)	10.00				
AT-AU	0/2588	-18.5	-18.5	0.12 (1)	10.00				
AU-L	0/2588	-18.5	-18.5	0.12 (1)	10.00				
L-AV	0/0	-18.5	-18.5	0.05 (1)	10.00				
AV-K	0/0	-18.5	-18.5	0.05 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-11-8	-38	-42	---	FRONT	VERT	DEAD	---	C1
C	2-11-8	-191	-191	---	FRONT	VERT	SNOW	---	C1
H	32-2-8	-38	-42	---	FRONT	VERT	DEAD	---	C1
H	32-2-8	-116	-116	---	FRONT	VERT	TOTAL	---	C1
H	32-2-8	-191	-191	---	FRONT	VERT	SNOW	---	C1
L	31-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
P	11-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
T	3-11-4	-111	-111	---	FRONT	VERT	TOTAL	---	C1
U	5-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	17-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	19-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	21-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	23-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	25-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	27-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AG	29-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AH	1-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AI	3-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AJ	5-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AK	7-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AL	9-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AM	13-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AN	15-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AO	17-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AP	19-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AQ	21-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AR	23-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AS	25-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AT	27-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AU	29-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AV	33-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007129

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T1Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310.8 Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 12:34:49 2020 Page 1
 ID:DMCubINVR8TstF0e31v8l_zns1f-qoL41NGw50yHWjVSripnNNrbzO1zT4?D9w8UBuzNBRK
 13.8 0-0 2.11.8 2.11.8 7.4.0 10-3.14 5.1.14 15.5-12 17.5-12 17.7.0 7.3.2 24.10-2 32.2-8 35.2-0 38.5-8
 13.8 5.9 2.11.8 2.11.8 7.4.0 10-3.14 32.10 13-0.8 15.5-12 2.0 17.5-12 17.7.0 18.9-8 8.9-10 24.10-2 7.4.0 32.2-8 2.11.8 5.9 13.8
 0.0 2.11.8 2.11.8 7.4.0 10-3.14 32.10 13-0.8 15.5-12 2.0 17.5-12 17.7.0 18.9-8 8.9-10 24.10-2 7.4.0 32.2-8 2.11.8 5.9 13.8
 35.2-0 38.5-8

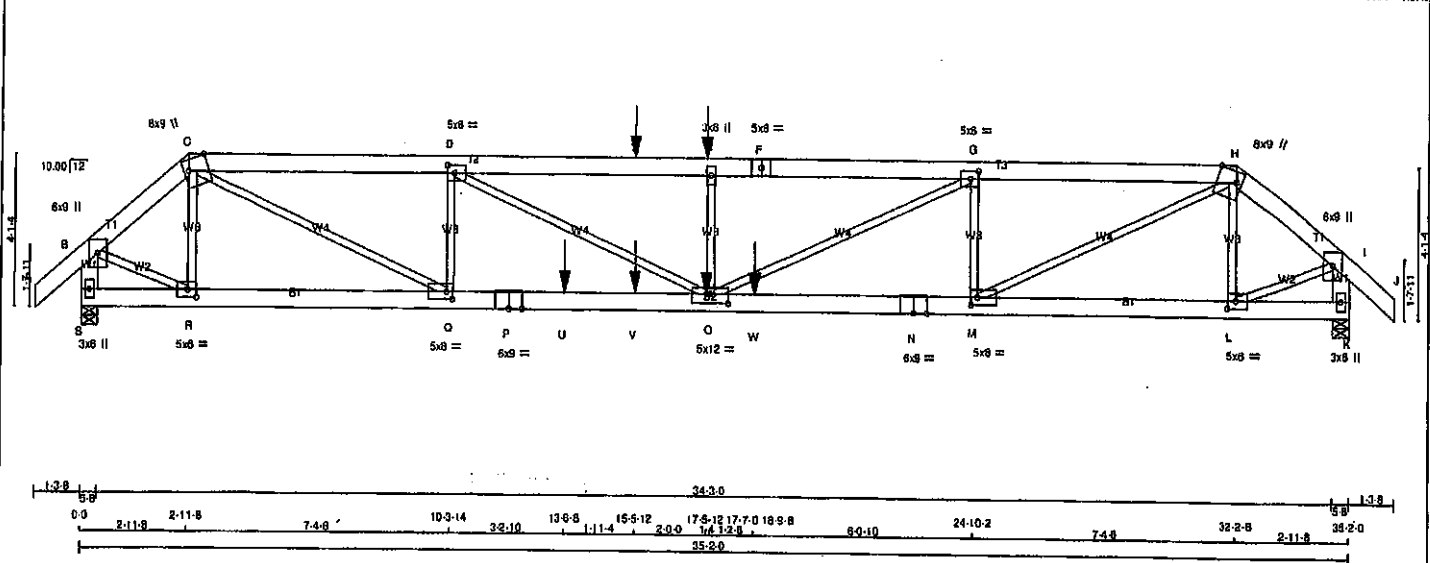

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	No.2	DESCR.
A - C	2x8	DRY	No.2	SPF			
O - F	2x8	DRY	No.2	SPF			
F - H	2x8	DRY	No.2	SPF			
H - J	2x8	DRY	No.2	SPF			
S - B	2x8	DRY	No.2	SPF			
K - I	2x8	DRY	No.2	SPF			
S - P	2x8	DRY	2100F 1.8E	SPF			
P - N	2x8	DRY	2100F 1.8E	SPF			
N - K	2x8	DRY	2100F 1.8E	SPF			

ALL WEBS 2x3 DRY No.2 SPF
 EXCEPT

DRY, SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE	LOAD (PLF)
TOP CHORDS: (0.122'X3') SPIRAL NAILS	SPACING (IN)	
A - C	2 12	TOP
C - F	2 12	TOP
F - H	2 12	TOP
H - J	2 12	TOP
S - B	2 12	TOP
K - I	2 12	TOP
BOTTOM CHORDS: (0.122'X3') SPIRAL NAILS		
S - P	2 12	TOP
P - N	2 12	SIDE (187.8)
N - K	2 12	TOP
WEBS: (0.122'X3') SPIRAL NAILS		
2x3	1 6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	HORZ	DOWN	BRG	BRG
S	3983	0	3983	0	5-8
K	3687	0	3687	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS	PERMALIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERMALIVE	WIND	DEAD
S	2783	1690/0	0/0	0/0	0/0	902/0
K	2599	1756/0	0/0	0/0	0/0	843/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.20 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0/42	-91.8	-91.8 0.04 (1)	10.00	R-C	-1098/0	0.13 (1)
B-C	-3988/0	-91.8	-91.8 0.08 (1)	5.85	C-Q	0/7263	0.90 (1)
C-D	-9534/0	-91.8	-91.8 0.37 (1)	3.74	Q-D	-2160/0	0.26 (1)
D-T	-12331/0	-91.8	-91.8 0.52 (1)	3.20	D-O	0/3130	0.39 (1)
T-E	-12331/0	-91.8	-91.8 0.52 (1)	3.20	O-E	-776/0	0.09 (1)
E-F	-12331/0	-91.8	-91.8 0.50 (1)	3.23	O-G	0/4203	0.82 (1)
F-G	-12331/0	-91.8	-91.8 0.50 (1)	3.23	M-G	-2813/0	0.31 (1)
G-H	-8575/0	-91.8	-91.8 0.33 (1)	3.94	M-H	0/6383	0.79 (1)
H-I	-3768/0	-91.8	-91.8 0.08 (1)	5.78	L-H	-843/0	0.10 (1)
I-J	0/42	-91.8	-91.8 0.04 (1)	10.00	B-R	0/3239	0.40 (1)
S-B	-3945/0	0.0	0.0 0.14 (1)	7.14	L-L	0/3052	0.38 (1)
K-I	-3733/0	0.0	0.0 0.13 (1)	7.29			
S-R	0/0	-18.5	-18.5 0.02 (4)	10.00			
R-Q	0/3013	-18.5	-18.5 0.21 (1)	10.00			
Q-P	0/8534	-18.5	-18.5 0.87 (1)	10.00			
P-U	0/8534	-18.5	-18.5 0.87 (1)	10.00			
U-V	0/8534	-18.5	-18.5 0.87 (1)	10.00			
V-O	0/8534	-18.5	-18.5 0.87 (1)	10.00			
O-W	0/8575	-18.5	-18.5 0.49 (1)	10.00			
W-N	0/8575	-18.5	-18.5 0.49 (1)	10.00			
N-M	0/8575	-18.5	-18.5 0.49 (1)	10.00			
M-L	0/2844	-18.5	-18.5 0.12 (1)	10.00			
L-K	0/0	-18.5	-18.5 0.05 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
JT	17-5-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
O	17-5-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
T	15-5-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	13-6-8	-1615	-1615	---	BACK	VERT	TOTAL	---	C1
V	15-5-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
W	18-9-8	-1620	-1620	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) CH: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.8 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, OBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-08, CSA 086-14
 - TPC 2011, TPC 2014

(55% OF 31.3 P.S.F. D.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17)
 CALCULATED VERT. DEFL. (LL) = L/909 (0.35)
 ALLOWABLE DEFL. (TL) = L/360 (1.17)
 CALCULATED VERT. DEFL. (TL) = L/657 (0.64)

CSL: TC=0.52/1.00 (D-E:1), BC=0.87/1.00 (O-Q:1), WB=0.80/1.00 (O-Q:1), SS=0.59/1.00 (M-O:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	818	354	1887	788
			1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (C) (INPUT = 0.90)
 JSI METAL = 0.95 (P) (INPUT = 1.00)



Structural component only
 DWG# T-2007130

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T1Z	1	2	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 © Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:34:49 2020 Page 2
ID:DMCubINVR6TslFag31v6l.zns1l-aol41NGw50yHWIVSrianNNrbzQlzT4?D9w8LJBuzNBRK

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	6.0	9.0		
C	TTWW+m	MT20	6.0	9.0	Edge	6.50
D	TMWW-l	MT20	5.0	6.0	2.50	2.50
E	TMW+w	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMWW-l	MT20	5.0	6.0	2.50	2.50
H	TTWW+m	MT20	6.0	9.0	Edge	6.50
I	TMVW+p	MT20	6.0	9.0		
K	BMV1+p	MT20	3.0	6.0		
L	BMWW-l	MT20	5.0	6.0	2.50	2.75
M	BMWW-l	MT20	5.0	6.0	2.50	2.00
N	BS-t	MT20	6.0	9.0		
O	BMWWW-l	MT20	5.0	12.0	3.00	6.00
P	BS-t	MT20	6.0	9.0		
Q	BMWW-l	MT20	5.0	6.0	2.50	2.00
R	BMWW-l	MT20	5.0	6.0	2.50	2.75
S	BMV1+p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2007130 42

JOB NAME 408168	TRUSS NAME T2	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 12:34:50 2020 Page 1
ID:DMCubINVR6TslFoe31v6l_zns1H7vSFH2sJ487a3lPPK0vaOkaofoCtaMOat1KzNBRJ
Scale = 1:57.3

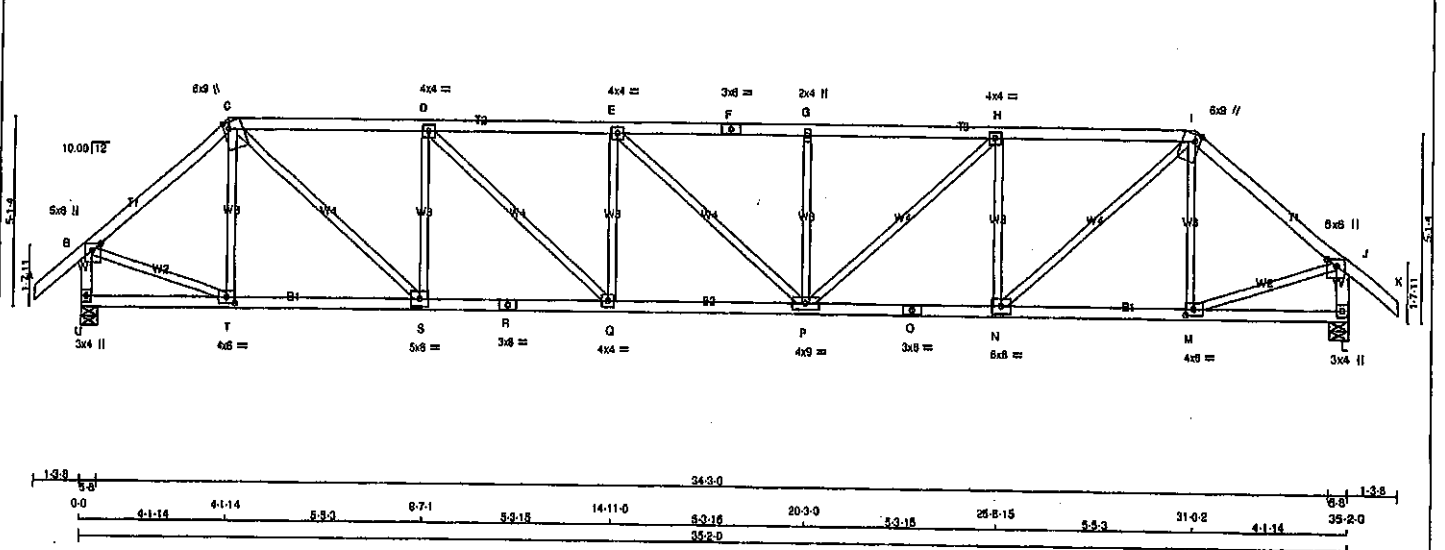

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	5.0	8.0	Edge 2.75
C	TTWW+m	MT20	8.0	9.0	Edge 1.75
D, E, H					
D	TMVW-i	MT20	4.0	4.0	
F	TS-i	MT20	3.0	8.0	
G	TMVW+w	MT20	2.0	4.0	
I	TTWW+m	MT20	8.0	9.0	Edge 1.75
J	TMVW+p	MT20	5.0	8.0	Edge 2.75
L	BMV1+p	MT20	3.0	4.0	
M	BMVW-i	MT20	4.0	8.0	2.00 2.75
N	BMVW-i	MT20	5.0	8.0	
O	BS-i	MT20	3.0	8.0	
P	BMVW+i	MT20	4.0	9.0	
Q	BMVW-i	MT20	4.0	4.0	
R	BS-i	MT20	3.0	8.0	
S	BMVW-i	MT20	5.0	8.0	
T	BMVW-i	MT20	4.0	8.0	2.00 2.75
U	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	HORIZ	BRG	IN-SX	BRG	IN-SX
U	2068	0	2068	0	0	5-8	5-8	5-8	5-8
L	2068	0	2068	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST CASE		MAX/MIN COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	COMBINED	SNOW	LIVE	PERM. LIVE
U	1458	971/0	0/0	0/0	0/0	488/0	0/0	1458	971/0	0/0	0/0
L	1458	971/0	0/0	0/0	0/0	488/0	0/0	1458	971/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		FACTORED		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PL)	LOI MAX	CSI (LC)	UNBRAC	MEMB.	FORCE (LBS)	VERT. LOAD (PL)	LOI MAX	CSI (LC)	UNBRAC
FR-TO						FR-TO					
A-B	0/41	-91.8	-91.8	0.13 (1)	10.00	T-C	-358/0	0.14 (1)			
B-C	-1960/0	-91.8	-91.8	0.38 (1)	4.48	C-S	0/1838	0.41 (1)			
C-D	-2871/0	-91.8	-91.8	0.57 (1)	3.59	S-D	-1118/0	0.43 (1)			
D-E	-3508/0	-91.8	-91.8	0.65 (1)	3.21	D-Q	0/658	0.19 (1)			
E-F	-3505/0	-91.8	-91.8	0.53 (1)	3.36	Q-E	-475/0	0.18 (1)			
F-G	-3505/0	-91.8	-91.8	0.53 (1)	3.36	E-P	-2/0	0.00 (1)			
G-H	-3505/0	-91.8	-91.8	0.66 (1)	3.20	P-G	-474/0	0.18 (1)			
H-I	-2871/0	-91.8	-91.8	0.57 (1)	3.59	P-H	0/853	0.19 (1)			
I-J	-1960/0	-91.8	-91.8	0.38 (1)	4.48	H-N	-1117/0	0.43 (1)			
J-K	0/41	-91.8	-91.8	0.13 (1)	10.00	N-I	0/1837	0.41 (1)			
U-B	-2037/0	0.0	0.0	0.22 (1)	5.92	M-I	-358/0	0.14 (1)			
L-J	-2037/0	0.0	0.0	0.22 (1)	5.92	B-T	0/1571	0.35 (1)			
U-T	0/0	-18.5	-18.5	0.10 (4)	10.00	M-J	0/1571	0.35 (1)			
T-S	0/1494	-18.5	-18.5	0.30 (1)	10.00						
S-R	0/2871	-18.5	-18.5	0.51 (1)	10.00						
R-Q	0/2871	-18.5	-18.5	0.51 (1)	10.00						
Q-P	0/3508	-18.5	-18.5	0.82 (1)	10.00						
P-O	0/2872	-18.5	-18.5	0.51 (1)	10.00						
O-N	0/2872	-18.5	-18.5	0.51 (1)	10.00						
N-M	0/1494	-18.5	-18.5	0.30 (1)	10.00						
M-L	0/0	-18.5	-18.5	0.10 (4)	10.00						

TOTAL WEIGHT = 2 X 147 = 293 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/989 (0.20")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/989 (0.39")

CSI: TO=0.88/1.00 (G-H-I), BC=0.82/1.00 (P-Q-I), WB=0.43/1.00 (D-S-I), SS=0.23/1.00 (H-I-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP=0.90 (N) (INPUT=0.80)
JSI METAL=0.90 (O) (INPUT=1.00)

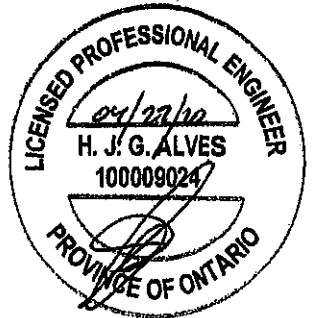

Structural component only
DWG# T-2007131

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T4	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 9 Oct 2019 Mitek Industries, Inc. Sat Apr 25 12:34:52 2020 Page 1
ID:DMCubINVR6TstF0e31v6I zns1I-EN1DIPpOxKsNAD1WqNU_?T6RbNZgQVruMBoDzNBRH
Scale = 1:57.5

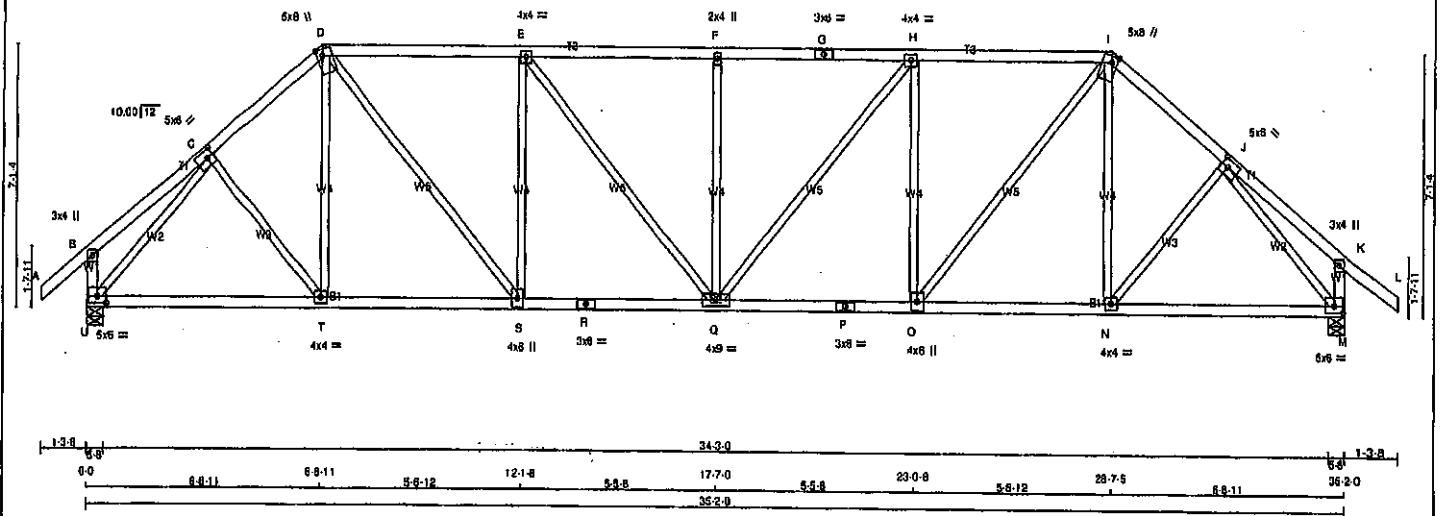

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - K	2x4	DRY	No.2
K - R	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0
C	TMWW-i	MT20	5.0	6.0 2.50 2.25
D	TTWW+m	MT20	5.0	8.0 2.00 1.75
E	TMWW-i	MT20	4.0	4.0
F	TMWW-w	MT20	2.0	4.0
G	TS-t	MT20	3.0	6.0
H	TMWW-i	MT20	4.0	4.0
I	TTWW+m	MT20	5.0	8.0 2.00 1.75
J	TMWW-i	MT20	5.0	6.0 2.50 2.25
K	TMV+p	MT20	3.0	4.0
M	BMWW-i	MT20	5.0	6.0 2.25 3.00
N	BMWW-t	MT20	4.0	4.0
O	BMWW-t	MT20	4.0	8.0
P	BS-t	MT20	3.0	6.0
Q	BMWW-i	MT20	4.0	8.0
R	BS-t	MT20	3.0	6.0
S	BMWW-t	MT20	4.0	8.0
T	BMWW-t	MT20	4.0	4.0
U	BMWW-i	MT20	5.0	6.0 2.25 3.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	8RG	8RG
U	2088	0	0	2088	0	0	5.8	5.8	5.8
M	2088	0	0	2088	0	0	5.8	5.8	5.8

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
U	1458	971/0	0/0	0/0	0/0
M	1458	971/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM	TO		FR-TO			
A-B	0/41	-91.8	-91.8	0.13 (1)	10.00	C-T	0/158	0.04 (1)
B-C	0/19	-91.8	-91.8	0.14 (1)	10.00	T-D	0/78	0.03 (4)
C-D	-2023/0	-91.8	-91.8	0.20 (1)	4.59	D-S	0/1220	0.27 (1)
D-E	-2308/0	-91.8	-91.8	0.55 (1)	3.94	S-E	-850/0	0.74 (1)
E-F	-2534/0	-91.8	-91.8	0.57 (1)	3.77	E-Q	0/381	0.08 (1)
F-G	-2534/0	-91.8	-91.8	0.57 (1)	3.77	Q-F	-481/0	0.40 (1)
G-H	-2534/0	-91.8	-91.8	0.57 (1)	3.77	Q-H	0/381	0.08 (1)
H-I	-2308/0	-91.8	-91.8	0.55 (1)	3.94	O-H	-850/0	0.74 (1)
I-J	-2023/0	-91.8	-91.8	0.20 (1)	4.59	O-I	0/1220	0.27 (1)
J-K	0/19	-91.8	-91.8	0.14 (1)	10.00	N-I	0/78	0.03 (4)
K-L	0/41	-91.8	-91.8	0.13 (1)	10.00	N-J	0/158	0.04 (1)
U-B	-248/0	0.0	0.0	0.03 (1)	7.81	U-C	-2277/0	0.98 (1)
M-K	-248/0	0.0	0.0	0.03 (1)	7.81	J-M	-2277/0	0.98 (1)
U-T	0/1433	-18.5	-18.5	0.33 (1)	10.00			
T-S	0/1535	-18.5	-18.5	0.35 (1)	10.00			
S-R	0/2308	-18.5	-18.5	0.42 (1)	10.00			
R-Q	0/2308	-18.5	-18.5	0.42 (1)	10.00			
Q-P	0/2308	-18.5	-18.5	0.42 (1)	10.00			
P-O	0/2308	-18.5	-18.5	0.42 (1)	10.00			
O-N	0/1535	-18.5	-18.5	0.35 (1)	10.00			
N-M	0/1433	-18.5	-18.5	0.33 (1)	10.00			

TOTAL WEIGHT = 2 X 162 = 323 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.13")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.23")

CSI: TC=0.57/1.00 (E-F); BC=0.42/1.00 (O-Q); I, W=0.99/1.00 (J-M); S=0.24/1.00 (D-E);

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1087 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (I) (INPUT = 0.90)
JSI METAL = 0.72 (P) (INPUT = 1.00)

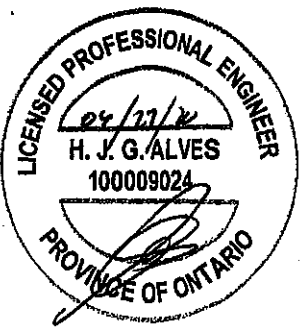

Structural component only
DWG# T-2007133

Version 8.310 8 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:53 2020 Page 1
ID:DMCubINVR6TslFoe31vbl_zns11habblJR9ES)_KoE4YulXDO0E7ipPtp4Y6hKfzNBRC
30.914 27.414 3.98 31.23 35.20 36.68
6.70 6.512 6.70 1.38
Scale = 1:57.1

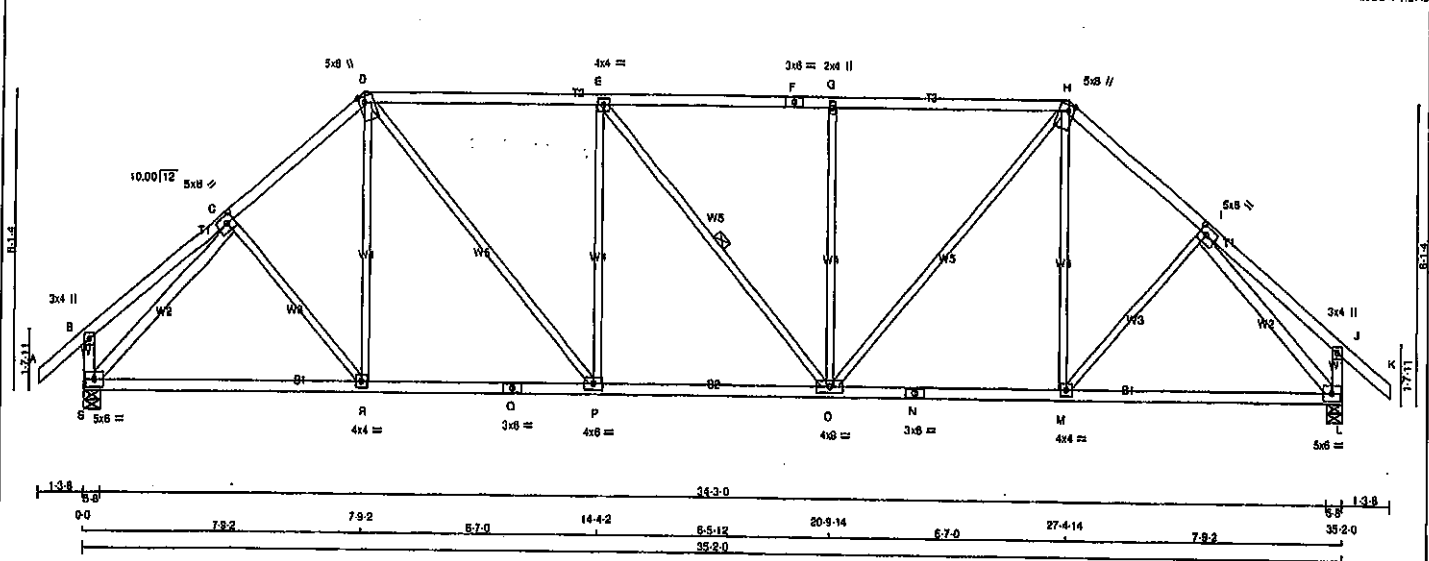

LUMBER			
N. L. G. A.	RULES		
CHORUS	SIZE		LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
J	TYPE	PLATES	W	LEN	Y	X
B	TMW+p	MT20	3.0	4.0		
C	TMWV-1	MT20	5.0	8.0	2.50	2.50
D	TTWV+m	MT20	5.0	8.0	2.00	1.75
E	TMWV-1	MT20	4.0	4.0		
F	TS-1	MT20	3.0	8.0		
G	TMW+w	MT20	2.0	4.0		
H	TTWV+m	MT20	5.0	8.0	2.00	1.75
I	TMWV-1	MT20	5.0	8.0	2.50	2.60
J	TMW+p	MT20	3.0	4.0		
L	8MWV-1	MT20	5.0	6.0		
M	8MWV-1	MT20	4.0	4.0		
N	BS-1	MT20	3.0	6.0		
O	8MWVW-1	MT20	4.0	9.0		
P	8MWV-1	MT20	4.0	6.0		
Q	BS-1	MT20	3.0	6.0		
R	8MWV-1	MT20	4.0	4.0		
S	8MWV-1	MT20	5.0	8.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
JT	2068	0	2068	0	0	5-8
S	2068	0	2068	0	0	5-8
L	2068	0	2068	0	0	5-8

UNFACTORED REACTIONS							
JT	1ST CASE		MAX./MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SO
S	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 /
L	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 /

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L'

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.81 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO			FR-TO			
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	C-R	0 / 84	0.02 (4)
B-C	0 / 28	-91.8	-91.8	0.21 (1)	10.00	R-D	0 / 126	0.04 (4)
C-D	-2006 / 0	-91.8	-91.8	0.29 (1)	4.50	D-P	0 / 988	0.22 (1)
D-E	-2163 / 0	-91.8	-91.8	0.73 (1)	3.81	E-P	-850 / 0	0.82 (1)
E-F	-2162 / 0	-91.8	-91.8	0.73 (1)	3.81	E-O	-2 / 0	0.00 (1)
F-G	-2162 / 0	-91.8	-91.8	0.73 (1)	3.81	O-G	-849 / 0	0.82 (1)
G-H	-2162 / 0	-91.8	-91.8	0.73 (1)	3.82	C-H	0 / 988	0.22 (1)
H-I	-2006 / 0	-91.8	-91.8	0.29 (1)	4.50	M-H	0 / 126	0.04 (4)
I-J	0 / 26	-91.8	-91.8	0.21 (1)	10.00	M-I	0 / 64	0.02 (4)
J-K	0 / 41	-91.8	-91.8	0.13 (1)	10.00	S-C	-2291 / 0	0.97 (1)
S-B	-284 / 0	0.0	0.0	0.03 (1)	7.81	I-L	-2281 / 0	0.97 (1)
L-J	-284 / 0	0.0	0.0	0.03 (1)	7.81			
S-R	0 / 1467	-18.5	-18.5	0.38 (1)	10.00			
R-Q	0 / 1519	-18.5	-18.5	0.39 (1)	10.00			
Q-P	0 / 1519	-18.5	-18.5	0.39 (1)	10.00			
P-O	0 / 2163	-18.5	-18.5	0.42 (1)	10.00			
O-N	0 / 1519	-18.5	-18.5	0.39 (1)	10.00			
N-M	0 / 1519	-18.5	-18.5	0.39 (1)	10.00			
M-L	0 / 1487	-18.5	-18.5	0.38 (1)	10.00			

DESIGN CRITERIA (M)

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2016

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL)= L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.21")

CSI: TC=0.73/1.00 (D-E:1), BC=0.42/1.00 (O-P:1),
WB=0.97/1.00 (I-L:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF
TRUSS PLATE MANUFACTURED IN NEW

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP (GRY) SHEAR SECTION

	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (R INPUT = 0.90)
JSI METAL= 0.56 (R INPUT = 1.00)

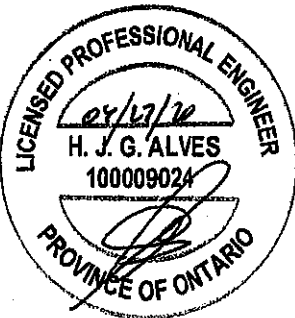

Structural component only
DWG# T-2007134


JOB NAME 408168	TRUSS NAME T6	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

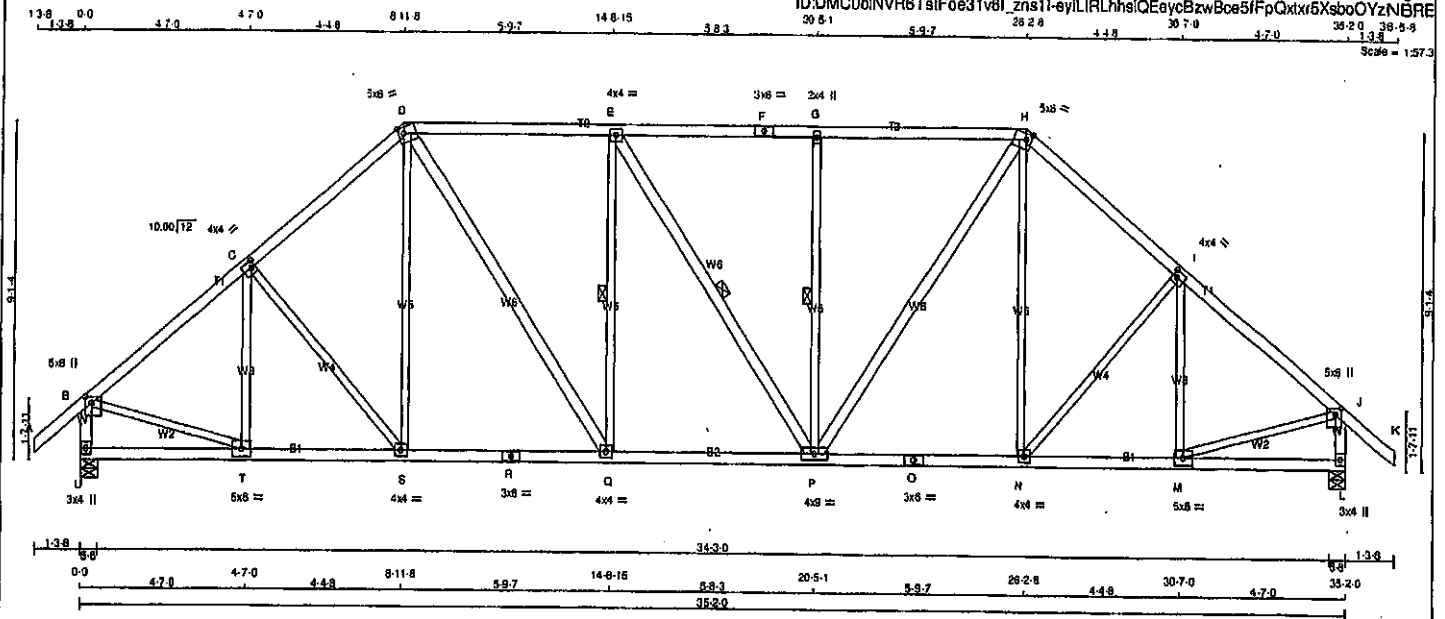

CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT
D - Q 2x4 DRY No.2
E - P 2x4 DRY No.2
P - H 2x4 DRY No.2

PLATES (table in inches)	W	LEN	Y	X
JT TYPE PLATES				
B TMVW+p MT20	5.0	8.0	2.00	2.00
C TMVW-i MT20	4.0	4.0	2.00	1.25
D TTWW-m MT20	5.0	8.0	2.00	1.75
E TMVW-i MT20	4.0	4.0		
F TS-i MT20	3.0	6.0		
G TMVW-m MT20	2.0	4.0		
H TTWW-m MT20	5.0	8.0	2.00	1.75
I TMVW-i MT20	4.0	4.0	2.00	1.25
J TMVW+p MT20	5.0	8.0	2.00	2.00
L BMV-i+p MT20	3.0	4.0		
M BMVW-i MT20	5.0	8.0		

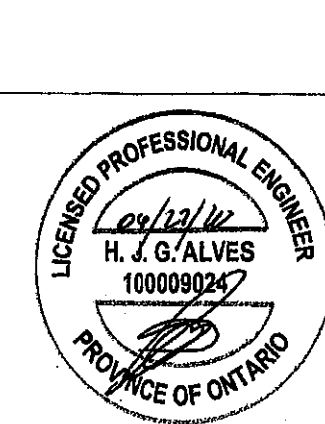

Structural component only
DWG# T-2007135

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORZ	UPLIFT
U	2088	0	0	5-8
L	2088	0	0	5-8

UNFACTORED REACTIONS	1ST CASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	SNOW
U	1458	971 / 0
L	1458	971 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.44 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, E-P, Q-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED MAX. CSI (LC)	UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED MAX. CSI (LC)
FR-TO						FR-TO			
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	T-C	-357 / 0	0.16 (1)	
B-C	-1894 / 0	-91.8	-91.8	0.30 (1)	4.53	C-S	-121 / 0	0.10 (1)	
C-D	-1957 / 0	-91.8	-91.8	0.29 (1)	4.57	S-D	0 / 108	0.05 (4)	
D-E	-1923 / 0	-91.8	-91.8	0.40 (1)	4.44	D-Q	0 / 810	0.13 (1)	
E-F	-1921 / 0	-91.8	-91.8	0.37 (1)	4.49	Q-E	-589 / 0	0.31 (1)	
F-G	-1921 / 0	-91.8	-91.8	0.37 (1)	4.49	E-P	-3 / 0	0.00 (1)	
G-H	-1921 / 0	-91.8	-91.8	0.40 (1)	4.45	P-G	-588 / 0	0.31 (1)	
H-I	-1957 / 0	-91.8	-91.8	0.29 (1)	4.57	P-H	0 / 807	0.13 (1)	
I-J	-1994 / 0	-91.8	-91.8	0.30 (1)	4.53	H-N	0 / 169	0.05 (4)	
J-K	0 / 41	-91.8	-91.8	0.13 (1)	10.00	N-I	-121 / 0	0.10 (1)	
U-B	-2028 / 0	0.0	0.0	0.22 (1)	5.84	M-I	-358 / 0	0.16 (1)	
L-J	-2028 / 0	0.0	0.0	0.22 (1)	5.84	B-T	0 / 1617	0.36 (1)	
						M-J	0 / 1617	0.36 (1)	
U-T	0 / 0	-18.5	-18.5	0.08 (4)	10.00				
T-S	0 / 1565	-18.5	-18.5	0.30 (1)	10.00				
S-R	0 / 1477	-18.5	-18.5	0.30 (1)	10.00				
R-Q	0 / 1477	-18.5	-18.5	0.30 (1)	10.00				
Q-P	0 / 1923	-18.5	-18.5	0.38 (1)	10.00				
P-O	0 / 1478	-18.5	-18.5	0.30 (1)	10.00				
O-N	0 / 1478	-18.5	-18.5	0.30 (1)	10.00				
N-M	0 / 1555	-18.5	-18.5	0.31 (1)	10.00				
M-L	0 / 0	-18.5	-18.5	0.08 (4)	10.00				

TOTAL WEIGHT = 2 X 182 = 363 lb (M/F)

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.08')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.16')

CSI: TC=0.40/1.00 (D-E:1), BC=0.38/1.00 (P-Q:1), WB=0.38/1.00 (B-T:1), SS=0.29/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1887 788 1887 1888


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (B) (INPUT = 0.80)
JSI METAL= 0.50 (C) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T8	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 9 Oct 2019 Mitek Industries, Inc. Sat Apr 25 12:34:57 2020 Page 1
ID:DMCubINVR6TsIFoe31v6I_zns11-bLq6j7MyDTz8T87JNyh3A_Cc6BLq307A4vTQzNBRC

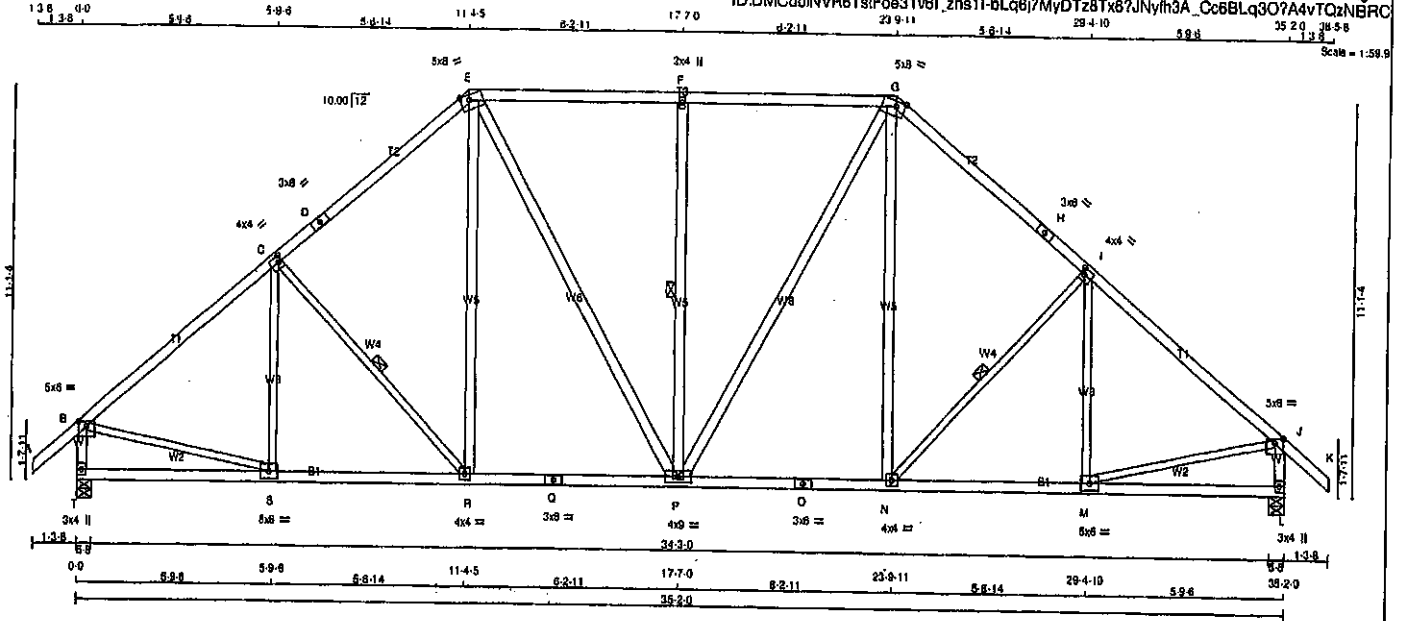

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
T - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
T - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS	2x4	DRY	No.2
EXCEPT			
S - C	2x3	DRY	No.2
C - R	2x3	DRY	No.2
N - I	2x3	DRY	No.2
M - I	2x3	DRY	No.2
B - S	2x3	DRY	No.2
M - J	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	5.0	8.0	1.50	3.00
C	TMWW-I	MT20	4.0	4.0	2.00	1.25
D	TS-I	MT20	3.0	8.0		
E	TTWW-m	MT20	5.0	8.0	Edge	3.00
F	TMWW-w	MT20	5.0	8.0		
G	TTWW-m	MT20	5.0	8.0	Edge	3.00
H	TS-I	MT20	3.0	8.0		
I	TMWW-I	MT20	4.0	4.0	2.00	1.25
J	TMWW-p	MT20	5.0	8.0	1.50	3.00
L	BMV-I+p	MT20	3.0	4.0		
M	BMWW-I	MT20	5.0	8.0		
N	BMWW-I	MT20	4.0	4.0		
O	BS-I	MT20	3.0	8.0		
P	BMWW-I	MT20	4.0	4.0		
Q	BS-I	MT20	3.0	8.0		
R	BMWW-I	MT20	4.0	4.0		
S	BMWW-I	MT20	5.0	8.0		
T	BMV-I+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORIZ	BRG	IN-SX	BRG	IN-SX
T	2068	0	2068	0	0	5-8	5-8		
L	2068	0	2068	0	0	5-8	5-8		

UNFACTORED REACTIONS

1ST LOOSE		MAX./MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
T	1458	971/0	0/0	0/0	0/0	488/0	0/0		
L	1458	971/0	0/0	0/0	0/0	488/0	0/0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.27 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-R, F-P, I-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0/41	-91.8	-91.8 0.13 (1)	10.00	S-C	-245/10	0.17 (1)
B-C	-2039/0	-91.8	-91.8 0.50 (1)	4.27	C-R	-314/0	0.15 (1)
C-D	-1844/0	-91.8	-91.8 0.48 (1)	4.47	R-E	0/338	0.05 (1)
D-E	-1844/0	-91.8	-91.8 0.48 (1)	4.47	E-P	0/469	0.08 (1)
E-F	-1821/0	-91.8	-91.8 0.50 (1)	4.80	P-F	-699/0	0.45 (1)
F-G	-1821/0	-91.8	-91.8 0.50 (1)	4.80	P-G	0/469	0.08 (1)
G-H	-1844/0	-91.8	-91.8 0.48 (1)	4.47	N-G	0/338	0.05 (1)
H-I	-1844/0	-91.8	-91.8 0.48 (1)	4.47	I-N	-314/0	0.15 (1)
I-J	-2039/0	-91.8	-91.8 0.50 (1)	4.27	M-I	-245/10	0.17 (1)
J-K	0/41	-91.8	-91.8 0.13 (1)	10.00	B-S	0/1637	0.37 (1)
T-B	-2021/0	0.0	0.0 0.21 (1)	5.94	M-J	0/1637	0.37 (1)
L-J	-2021/0	0.0	0.0 0.21 (1)	5.94			

T-S	0/0	-18.5	-18.5 0.14 (4)	10.00
S-R	0/1597	-18.5	-18.5 0.33 (1)	10.00
R-Q	0/1387	-18.5	-18.5 0.30 (1)	10.00
Q-P	0/1387	-18.5	-18.5 0.30 (1)	10.00
P-O	0/1387	-18.5	-18.5 0.30 (1)	10.00
O-N	0/1387	-18.5	-18.5 0.30 (1)	10.00
N-M	0/1597	-18.5	-18.5 0.33 (1)	10.00
M-L	0/0	-18.5	-18.5 0.14 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.50/1.00 (E-F:1), BC=0.33/1.00 (M-N:1), WB=0.45/1.00 (F-P:1), SS=0.28/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	818	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (J) (INPUT = 0.90)
JSI METAL = 0.47 (O) (INPUT = 1.00)




Structural component only
DWG# T-2007137

CONTINUED ON PAGE 2

[illegible]

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	G9	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Sat Apr 25 12:34:40 2020 Page 1
ID:DMCubINVR6TstFos31v6I 2ns11-b4lh8J9HDFpZxKJkpJgVTzANmNyICAU40SMwzNBRT

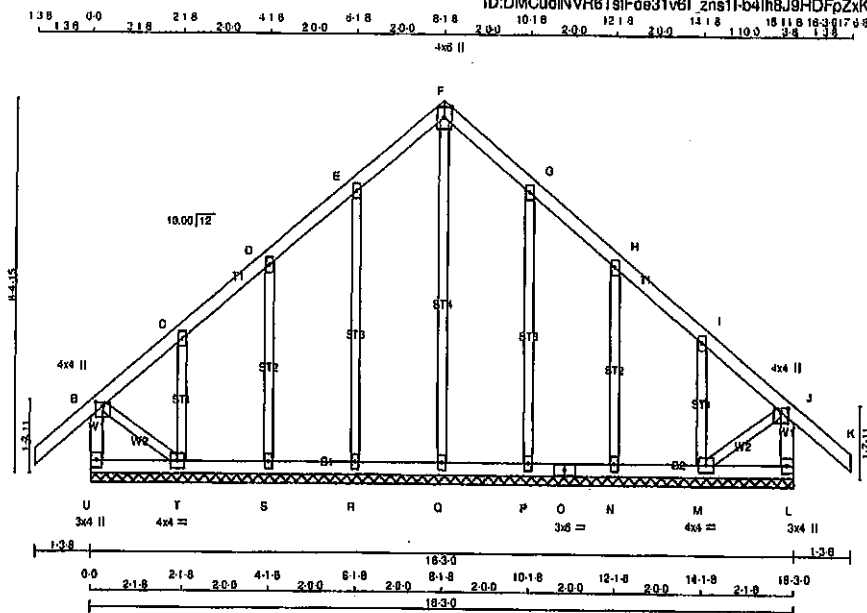

Scale: 1/4"=1'

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - F	2x4	DRY	No.2
F - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY; SEASONED LUMBER.			
GABLE STUDS SPACED AT 2'-0" OC.			

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMW+p	MT20	4.0	4.0	1.00	2.00
C, D, E, G, H, I					
C TMW+w	MT20	2.0	4.0		
F TTW+p	MT20	4.0	8.0	Edge	
J TMW+p	MT20	4.0	4.0	1.00	2.00
L BMV1+p	MT20	3.0	4.0		
M BMW1+1	MT20	4.0	4.0		
N, P, Q, R, S					
N BMW1+w	MT20	2.0	4.0		
O BS-1	MT20	3.0	6.0		
T BMW1+1	MT20	4.0	4.0		
U BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER
BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)
BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)	
FR-TO				FR-TO			
A-B	0/41	-91.8	-91.8 0.13 (1)	Q-F	-124/0	0.17 (1)	
B-C	-28/0	-91.8	-91.8 0.05 (1)	R-E	-210/0	0.18 (1)	
C-D	-38/0	-91.8	-91.8 0.05 (1)	S-D	-169/0	0.08 (1)	
D-E	-24/0	-91.8	-91.8 0.05 (1)	T-C	-205/0	0.04 (1)	
E-F	-38/0	-91.8	-91.8 0.05 (1)	P-G	-210/0	0.18 (1)	
F-G	-38/0	-91.8	-91.8 0.05 (1)	N-H	-169/0	0.08 (1)	
G-H	-24/0	-91.8	-91.8 0.05 (1)	M-I	-205/0	0.04 (1)	
H-I	-38/0	-91.8	-91.8 0.05 (1)	B-T	0/37	0.01 (1)	
I-J	-28/0	-91.8	-91.8 0.05 (1)	M-J	0/37	0.01 (1)	
J-K	0/41	-91.8	-91.8 0.13 (1)				
U-B	-248/0	0.0	0.0 0.03 (1)				
L-J	-248/0	0.0	0.0 0.03 (1)				
U-T	0/0	-18.5	-18.5 0.02 (4)				
T-S	0/25	-18.5	-18.5 0.02 (4)				
S-R	0/21	-18.5	-18.5 0.02 (4)				
R-Q	0/18	-18.5	-18.5 0.02 (4)				
Q-P	0/18	-18.5	-18.5 0.02 (4)				
P-O	0/21	-18.5	-18.5 0.02 (4)				
O-N	0/21	-18.5	-18.5 0.02 (4)				
N-M	0/25	-18.5	-18.5 0.02 (4)				
M-L	0/0	-18.5	-18.5 0.02 (4)				

TOTAL WEIGHT = 81 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 26.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPO 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (A-B:1), BC=0.02/1.00 (M-N:4),
WB=0.17/1.00 (F-G:1), SSI=0.08/1.00 (A-B:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1997 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.52 (T) (INPUT = 0.90)
JSI METAL = 0.11 (G) (INPUT = 1.00)




Structural component only
DWG# T-2007123

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T10	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 9 Oct 2019 MITek Industries, Inc. Sat Apr 25 12:34:59 2020 Page 1
ID:DMCubINVR6TsIFoe31v6l_zns11-Xlvs8aOCi4DsIFFNQo?7nUGOUQrOpqnhSUZ?XJzNBRA

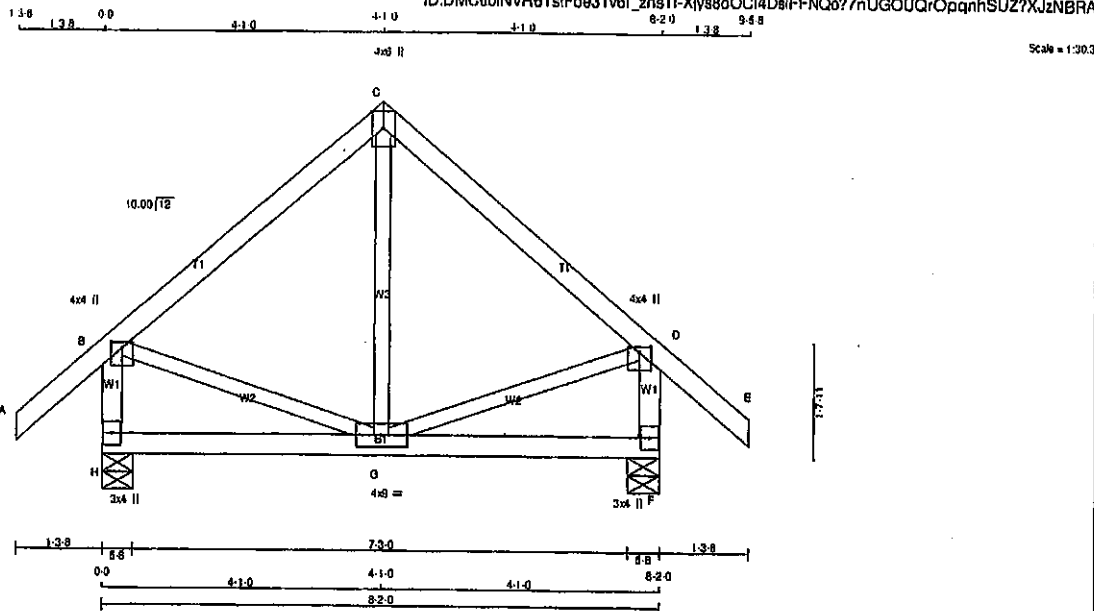

TOTAL WEIGHT = 38 lb
(M/F)

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - D	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
C	TTW+p	MT20	4.0	6.0	Edge
D	TMVW+p	MT20	4.0	4.0	1.00 2.00
F	BMV1+p	MT20	3.0	4.0	
G	BMVWV-t	MT20	4.0	9.0	
H	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED	MAXIMUM FACTORED		INPUT	REQD		
	GROSS REACTION	GROSS REACTION		BRG	BRG		
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
H	577	0	577	0	0	5-8	5-8
F	577	0	577	0	0	5-8	5-8

UNFACTORED REACTIONS							
JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	408	280 / 0	0 / 0	0 / 0	0 / 0	128 / 0	0 / 0
F	408	280 / 0	0 / 0	0 / 0	0 / 0	128 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING							
TOTAL LOAD CASES: (4)							
CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	G-C	-37 / 57	0.02 (4)
B-C	-264 / 0	-91.8	-91.8 0.20 (1)	8.25	B-G	0 / 213	0.05 (1)
C-D	-264 / 0	-91.8	-91.8 0.20 (1)	8.25	G-D	0 / 213	0.05 (1)
D-E	0 / 41	-91.8	-91.8 0.13 (1)	10.00			
H-B	-548 / 0	0.0	0.0 6.08 (1)	7.81			
F-D	-548 / 0	0.0	0.0 6.08 (1)	7.81			
H-G	0 / 0	-18.5	-18.5 0.09 (4)	10.00			
G-F	0 / 0	-18.5	-18.5 0.09 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.27")
CALCULATED VERT. DEFL.(LL) = L/989 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.27")
CALCULATED VERT. DEFL.(TL) = L/989 (0.01")

CSI: TC=0.20/1.00 (B-C:1), BC=0.09/1.00 (F-G:4),
WB=0.08/1.00 (D-G:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.48 (D) (INPUT = 0.80)
JSI METAL = 0.12 (D) (INPUT = 1.00)



Structural component only
DWG# T-2007139

JOB NAME 408168	TRUSS NAME G10	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2018 Mike Industries, Inc. Sat Apr 28 12:34:41 2020 Page 1
ID:DMCubINVR8TsiFos31v6I_zns11-3Gs3MeAv_YyQYUwN0gv2hWL7AjCchL2JgC3vMzNBRS

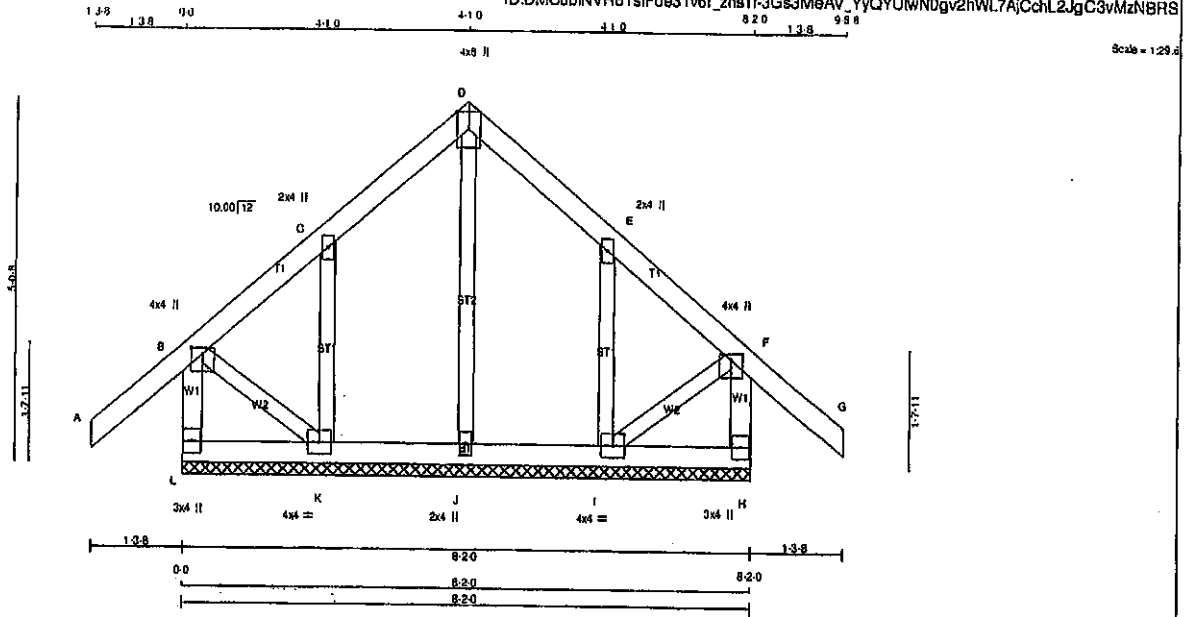

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
L - B	2x4	DRY	No.2
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C TMW+w	MT20	2.0	4.0		
D TTW+p	MT20	4.0	8.0	Edge	
E TMW+w	MT20	2.0	4.0		
F TMVW+p	MT20	4.0	4.0	1.00	2.00
H BMV1+p	MT20	3.0	4.0		
I BMW1-i	MT20	4.0	4.0		
J BMW1+w	MT20	2.0	4.0		
K BMW1-i	MT20	4.0	4.0		
L BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.									
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.									
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)									
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.									
LOADING									
TOTAL LOAD CASES: (4)									
CHORDS									
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)	MAX. FACTORED UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	FACTORED VERT. LOAD (PLF)
FR-TO						FR-TO			
L-B	-224 / 0	0.0	0.0	0.02 (1)	7.81	J-D	-126 / 0	0.05 (1)	0.05 (1)
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	K-C	-227 / 0	0.04 (1)	0.04 (1)
B-C	-11 / 0	-91.8	-91.8	0.06 (1)	8.25	I-E	-227 / 0	0.04 (1)	0.04 (1)
C-D	-31 / 0	-91.8	-91.8	0.08 (1)	8.25	B-K	0 / 24	0.01 (1)	0.01 (1)
D-E	-31 / 0	-91.8	-91.8	0.08 (1)	8.25	I-F	0 / 24	0.01 (1)	0.01 (1)
E-F	-11 / 0	-91.8	-91.8	0.08 (1)	8.25				
F-G	0 / 41	-91.8	-91.8	0.13 (1)	10.00				
H-F	-224 / 0	0.0	0.0	0.02 (1)	7.81				
L-K	0 / 0	-18.5	-18.5	0.02 (4)	10.00				
K-J	0 / 13	-18.5	-18.5	0.02 (4)	10.00				
J-I	0 / 13	-18.5	-18.5	0.02 (4)	10.00				
I-H	0 / 0	-18.5	-18.5	0.02 (4)	10.00				

TOTAL WEIGHT = 40 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2018, OBC 2012, ABC 2010
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 085-14
- TPIC 2011, TPIC 2014

(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (A-B:1), BC=0.02/1.00 (J-K:4), WB=0.05/1.00 (D-J:1), SS=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX	MIN	MAX MIN
MT20	818	354 1687 788 1687 1688

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.17 (C) (INPUT = 0.80)
JSI METAL = 0.12 (C) (INPUT = 1.00)

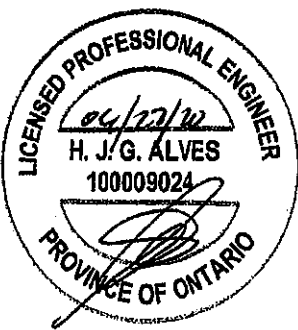

Structural component only
DWG# T-2007124

JOB NAME 408168	TRUSS NAME T11	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 28 2019 MTek Industries, Inc. Sat Apr 25 12:35:00 2020 Page 1
ID:DMCubINVR6TslFoe31v6l_zns1f-7wWEL8PqVOLikPqa_WWWJhoZlq8hYBarh8IZ4IzNB8R9

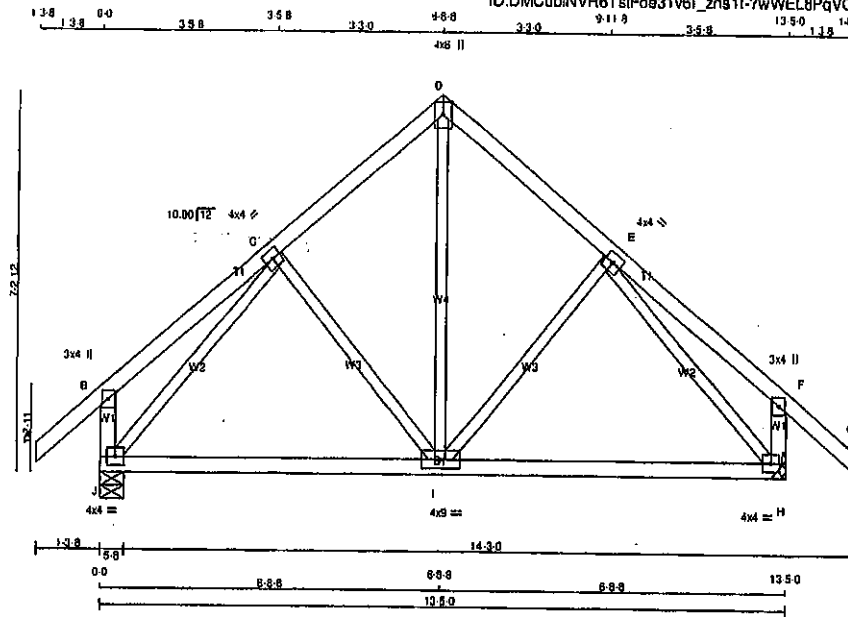

Scale = 1:10.5

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMV-p	MT20	3.0	4.0		
C TMVW-t	MT20	4.0	4.0		
D TTW-p	MT20	4.0	6.0		Edge
E TMVW-t	MT20	4.0	4.0		
F TMV-p	MT20	3.0	4.0		
H BMVW-t	MT20	4.0	4.0		
I BMVW-t	MT20	4.0	9.0		
J BMVW-t	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	DOWN	HORIZ	UPLIFT	IN-SX
J	867	0	867	0	5-8
H	867	0	867	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	811	414 / 0	0 / 0	0 / 0	0 / 0	198 / 0	0 / 0
H	811	414 / 0	0 / 0	0 / 0	0 / 0	198 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO				FR-TO			
A-B	0 / 41	-91.8	-91.8 (1)	10.00	I-D	0 / 382	0.09 (1)
B-C	0 / 23	-91.8	-91.8 (1)	10.00	I-E	-149 / 0	0.07 (1)
C-D	-509 / 0	-91.8	-91.8 (1)	6.25	C-I	-149 / 0	0.07 (1)
D-E	-509 / 0	-91.8	-91.8 (1)	6.25	J-C	-742 / 0	0.33 (1)
E-F	0 / 23	-91.8	-91.8 (1)	10.00	E-H	-742 / 0	0.33 (1)
F-G	0 / 41	-91.8	-91.8 (1)	10.00			
J-B	-244 / 0	0.0	0.0 (1)	7.81			
H-F	-244 / 0	0.0	0.0 (1)	7.81			
J-I	0 / 469	-18.5	-18.5 (4)	10.00			
I-H	0 / 469	-18.5	-18.5 (4)	10.00			

TOTAL WEIGHT = 3 X 64 = 191 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2015, ABC 2010
- PART 9 OF OBC 2012 (10th AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.45")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.45")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSI: TC=0.16/1.00 (E-F:1), BC=0.27/1.00 (I-J:4),
WB=0.39/1.00 (E-H:1), SSI=0.11/1.00 (D-E:1)
DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.84 (E) (INPUT = 0.90)
JSI METAL = 0.27 (E) (INPUT = 1.00)

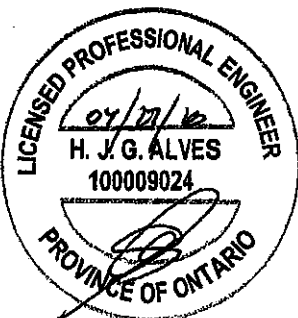


Structural component only
DWG# T-2007140

JOB NAME	TRUSS NAME	QUANTITY	PLV	JOB DESC.	DRWG NO.
408168	G11	1	1	GREEN PARK HOMES	
Temarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 8 Oct 2019 MITek Industries, Inc. Sat Apr 25 12:34:42 2020 Page 1
ID:DMCubINVR6TsiFoe31v8I_zns1I-XSQRZ_BXis4GAeS6xk88au3Wz3HL6XBYKxcRozNBRR

Scale = 1/40.5

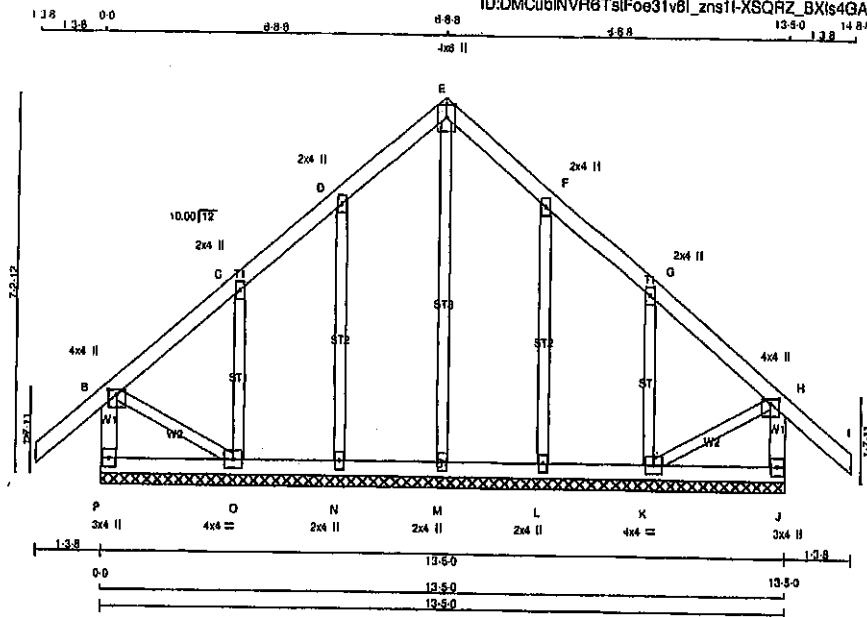

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
P - B	2x4	DRY	No.2
A - E	2x4	DRY	No.2
E - I	2x4	DRY	No.2
J - H	2x4	DRY	No.2
P - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			
GABLE STUDS SPACED AT 2'-0" O.C.			

PLATES (table in inches)			
JT TYPE	PLATES	W	LEN Y X
B TMVW+p	MT20	4.0	4.0 1.00 2.00
C, D, F, G			
C TMVW+w	MT20	2.0	4.0
E TTW+p	MT20	4.0	6.0 Edge
H TMVW+p	MT20	4.0	4.0 1.00 2.00
J BMV1+p	MT20	3.0	4.0
K BMW1-i	MT20	4.0	4.0
L, M, N			
L BMW1+w	MT20	2.0	4.0
O BMW1-i	MT20	4.0	4.0
P BMV1+p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S).

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 0.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LG1 (PLF)	MAX. CS1 (LC)
FR-TO			
P-B	-263 / 0	0.0	0.0 0.03 (1)
A-B	0 / 41	-91.8	-91.8 0.13 (1)
B-C	-24 / 0	-91.8	-91.8 0.08 (1)
C-D	-38 / 0	-91.8	-91.8 0.08 (1)
D-E	-35 / 0	-91.8	-91.8 0.08 (1)
E-F	-35 / 0	-91.8	-91.8 0.08 (1)
F-G	-38 / 0	-91.8	-91.8 0.08 (1)
G-H	-24 / 0	-91.8	-91.8 0.08 (1)
H-I	0 / 41	-91.8	-91.8 0.13 (1)
J-H	-263 / 0	0.0	0.0 0.03 (1)
P-O	0 / 0	-18.5	-18.5 0.03 (4)
O-N	0 / 22	-18.5	-18.5 0.03 (4)
N-M	0 / 19	-18.5	-18.5 0.02 (4)
M-L	0 / 19	-18.5	-18.5 0.02 (4)
L-K	0 / 22	-18.5	-18.5 0.03 (4)
K-J	0 / 0	-18.5	-18.5 0.03 (4)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019

- PART 9 OF CBC 2012 (2019 AMENDMENT)

- CSA 086-09, CSA 088-14

- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS: TC=0.13/1.00 (H-I), BC=0.03/1.00 (K-L), WB=0.11/1.00 (E-M), SS=0.08/1.00 (G-H)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1687 788 1987 1688

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.20 (B) (INPUT = 0.90)

JSI METAL= 0.13 (G) (INPUT = 1.00)



Structural component only
DWG# T-2007125

JOB NAME 408168	TRUSS NAME T12	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:35:01 2020 Page 1					
ID:DMCubINVR6TstFoe31v6l_zns11-T63dYUPSGITayZPmYD1bsvLjXEW1Hh1_vn26cCznBR8					
Scale = 1:10.0					

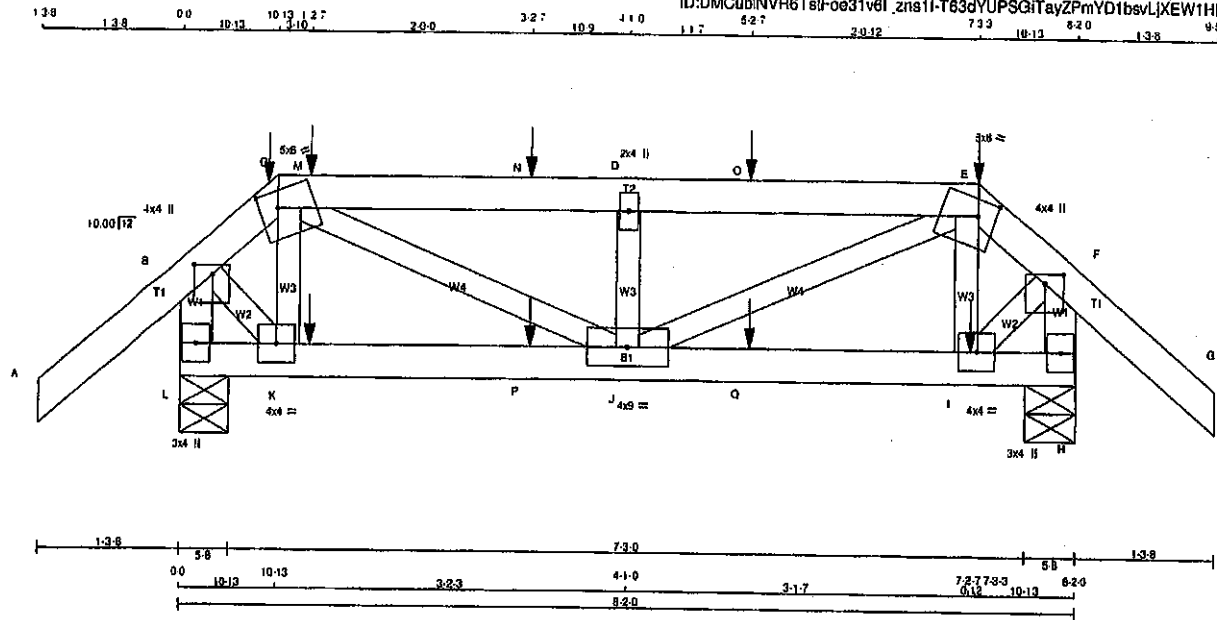

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - H	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTWW-m	MT20	5.0	8.0	1.75	2.00
D	TMW+w	MT20	2.0	4.0		
E	TTWW-m	MT20	5.0	8.0	1.75	2.00
F	TMVW+p	MT20	4.0	4.0	1.00	2.00
H	BMV1+p	MT20	3.0	4.0		
I	BMVW-w	MT20	4.0	4.0		
J	BMVW-w	MT20	4.0	9.0		
K	BMVW-w	MT20	4.0	4.0		
L	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
L	913	0	913	0	0	5-8	5-8	5-8	5-8
H	911	0	911	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	642	442 / 0	0 / 0	0 / 0	0 / 0	0 / 0	189 / 0	0 / 0
H	641	437 / 0	0 / 0	0 / 0	0 / 0	0 / 0	204 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.82 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO			FR-TO			
A-B	0 / 41	-91.8	-91.8	1.14 (1)	10.00	J-D	-487 / 0	0.08 (1)
B-C	-631 / 0	-91.8	-91.8	0.14 (1)	8.25	K-Q	-158 / 0	0.02 (1)
C-M	-1054 / 0	-91.8	-91.8	0.23 (1)	5.82	G-J	0 / 700	0.17 (1)
M-N	-1054 / 0	-91.8	-91.8	0.23 (1)	5.82	B-K	0 / 525	0.13 (1)
N-D	-1054 / 0	-91.8	-91.8	0.23 (1)	5.82	I-E	-149 / 0	0.02 (1)
D-O	-1054 / 0	-91.8	-91.8	0.23 (1)	5.82	J-E	0 / 688	0.17 (1)
O-E	-1054 / 0	-91.8	-91.8	0.23 (1)	5.82	I-F	0 / 528	0.13 (1)
E-F	-632 / 0	-91.8	-91.8	0.14 (1)	8.25			
F-G	0 / 41	-91.8	-91.8	0.14 (1)	10.00			
L-B	-938 / 0	0.0	0.0	0.10 (1)	7.81			
H-F	-937 / 0	0.0	0.0	0.10 (1)	7.81			
L-K	0 / 0	-18.5	-18.5	0.05 (1)	10.00			
K-P	0 / 420	-18.5	-18.5	0.13 (1)	10.00			
P-J	0 / 420	-18.5	-18.5	0.13 (1)	10.00			
J-Q	0 / 421	-18.5	-18.5	0.14 (1)	10.00			
Q-I	0 / 421	-18.5	-18.5	0.14 (1)	10.00			
I-H	0 / 0	-18.5	-18.5	0.05 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LOC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	10-13	-9	-10	---	FRONT	VERT	DEAD	---	C1
C	1-2-7	-114	-114	---	BACK	VERT	TOTAL	---	C1
C	10-13	-44	-44	---	FRONT	VERT	DEAD	---	C1
E	7-3-3	-9	-10	---	FRONT	VERT	SNOW	---	C1
E	7-3-3	-90	-90	---	BACK	VERT	TOTAL	---	C1
E	7-3-3	-44	-44	---	FRONT	VERT	SNOW	---	C1
I	7-2-7	-49	-49	---	BACK	VERT	TOTAL	---	C1
K	1-2-7	-49	-49	---	BACK	VERT	TOTAL	---	C1
N	3-2-7	-82	-82	---	BACK	VERT	TOTAL	---	C1
O	5-2-7	-82	-82	---	BACK	VERT	TOTAL	---	C1
P	3-2-7	-49	-49	---	BACK	VERT	TOTAL	---	C1
Q	5-2-7	-49	-49	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.27")

CALCULATED VERT. DEFL.(LL) = L/999 (0.02")

ALLOWABLE DEFL.(TL) = L/360 (0.27")

CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.23/1.00 (C-D:1), BC=0.14/1.00 (I-J:1), WB=0.17/1.00 (C-J:1), SSI=0.22/1.00 (C-D:1)

DOE LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PL) (PL)

MAX MIN MAX MIN MAX MIN

MT20 818 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

CONTINUED ON PAGE 2



Structural component only
DWG# T-2007141

JOB NAME 408168	TRUSS NAME T13	QUANTITY 1	PLV 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:36:03 2020 Page 1					
ID:DMCubINVR6T8tF0831v6L_zns11-PVBNzARioJl[BsZ9t633xKQvZ1CWYJHN5XDq4zNBR6					
4-2-6 7-7-0 10-9 8-5-8					
Scale = 1:17.3					

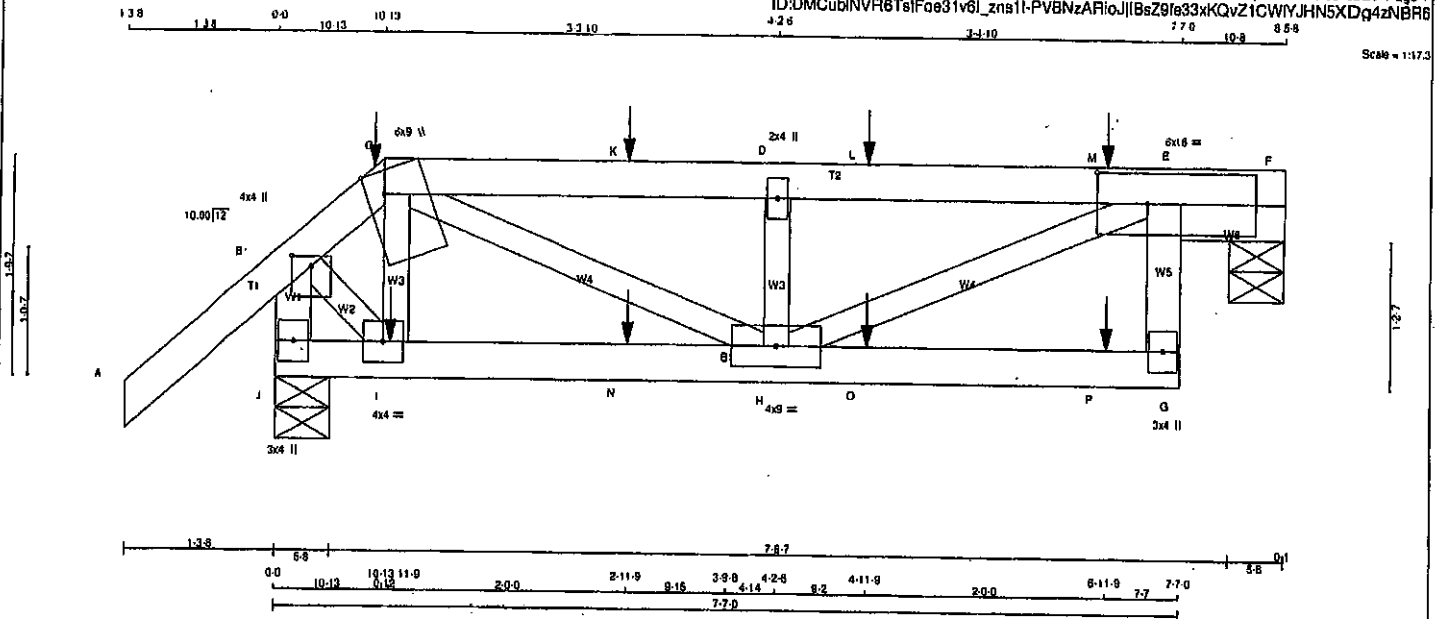

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
G - E	2x4	DRY	No.2	SPF	
J - B	2x4	DRY	No.2	SPF	
J - G	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY
DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00	
C TTWW+m	MT20	6.0	9.0	Edge	1.75	
D TMVW+w	MT20	2.0	4.0			
E TMVWW-1	MT20	6.0	16.0	3.00	5.00	
G BMV+p	MT20	3.0	4.0			
H BMVWW-1	MT20	4.0	9.0			
I BMVW-1	MT20	4.0	4.0			
J BMV1+p	MT20	3.0	4.0			

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT VERT	HORZ	DOWN	HORZ	UPLIFT
F 695	0	695	0	0
J 936	0	936	0	0

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): F

UNFACTORED REACTIONS	1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
F	490	327/0	0/0
J	659	449/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	WEBS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX
MEMB.	FORCE	(LBS)	FROM	TO	CSI (LC)	MEMB.	FORCE	(LBS)	FROM	TO	CSI (LC)
A-B	0/41	-91.8	-91.8	0.14 (1)	10.00	I-C	-168/0	0.03 (1)			
B-C	-658/0	-91.8	-91.8	0.14 (1)	6.25	B-1	0/548	0.14 (1)			
C-K	-1230/0	-91.8	-91.8	0.48 (1)	5.09	H-D	-767/0	0.12 (1)			
K-D	-1230/0	-91.8	-91.8	0.48 (1)	5.09	C-H	0/567	0.21 (1)			
D-L	-1230/0	-91.8	-91.8	0.89 (1)	3.58	H-E	0/1345	0.33 (1)			
L-M	-1230/0	-91.8	-91.8	0.89 (1)	3.58						
M-E	-1230/0	-91.8	-91.8	0.89 (1)	3.58						
E-F	0/0	-91.8	-91.8	0.35 (1)	10.00						
G-E	0/83	0.0	0.0	0.02 (4)	10.00						
J-B	-966/0	0.0	0.0	0.11 (1)	7.81						
J-I	0/0	-18.5	-18.5	0.06 (1)	10.00						
I-N	0/438	-18.5	-18.5	0.14 (1)	10.00						
N-H	0/438	-18.5	-18.5	0.14 (1)	10.00						
H-O	0/0	-18.5	-18.5	0.08 (1)	10.00						
O-P	0/0	-18.5	-18.5	0.08 (1)	10.00						
P-G	0/0	-18.5	-18.5	0.08 (1)	10.00						

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	10-13	-8	-10	---	---	FRONT	VERT	DEAD	---	C1
C	10-13	-80	-90	---	---	FRONT	VERT	TOTAL	---	C1
C	10-13	-44	-44	---	---	FRONT	VERT	SNOW	---	C1
I	11-9	-49	-49	---	---	FRONT	VERT	TOTAL	---	C1
K	2-11-9	-82	-82	---	---	FRONT	VERT	TOTAL	---	C1
L	4-11-9	-82	-82	---	---	FRONT	VERT	TOTAL	---	C1
M	6-11-9	-82	-82	---	---	FRONT	VERT	TOTAL	---	C1
N	2-11-9	-49	-49	---	---	FRONT	VERT	TOTAL	---	C1
O	4-11-9	-49	-49	---	---	FRONT	VERT	TOTAL	---	C1
P	8-11-9	-53	-53	---	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(85 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.25")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (0.25")
CALCULATED VERT. DEFL.(TL) = L/688 (0.13")

CSI: TC=0.89/1.00 (D-E:1), BC=0.14/1.00 (H-I:1), WB=0.33/1.00 (E-H:1), SS=0.42/1.00 (D-E:1)

DCL LUMBER=1.00 NAIL=1.00 LB BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 766 1937 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.79 (C) (INPUT = 0.80)
JSI METAL = 0.30 (H) (INPUT = 1.00)

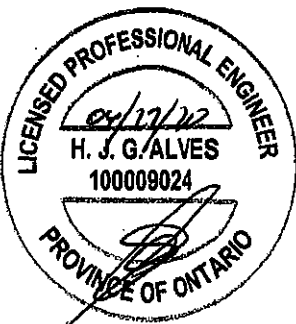

Structural component only
DWG# T-2007142


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408169	T20	1	2	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:24 2020 Page 1

ID:K7TPdhgJ0nqHqYdbWOFzIdG-8ltgasn1sB7_Budbz0zKub4B6zN_xr0MZbH0gzNBD

Scale = 1:57.2

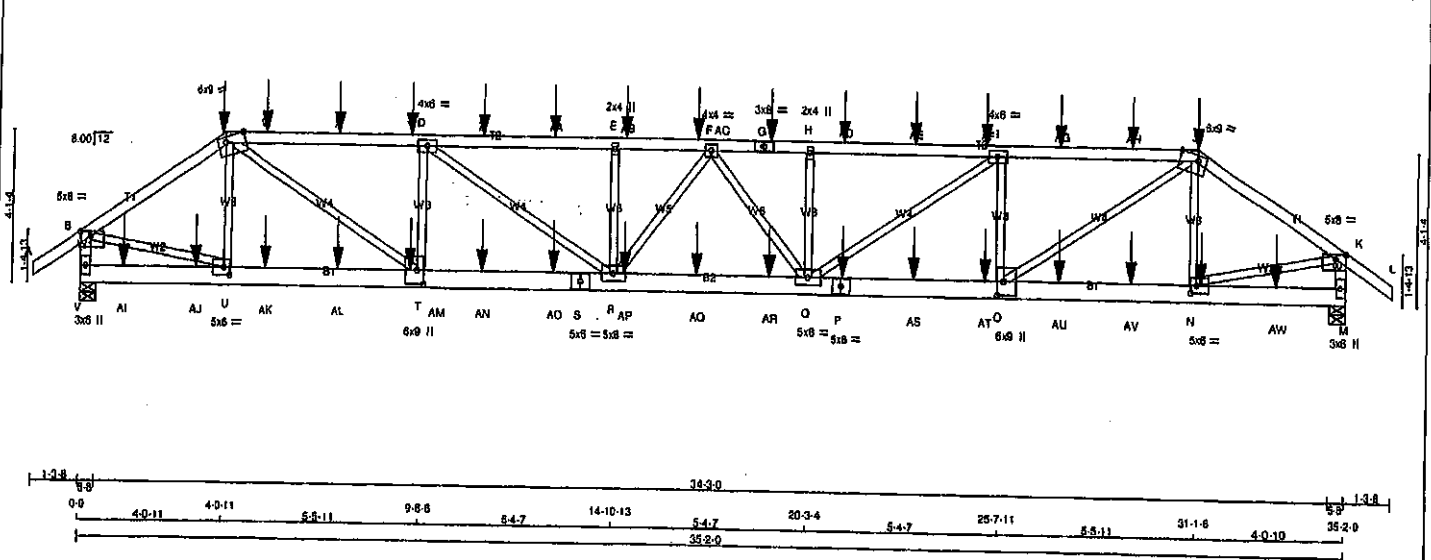

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
J - L	2x4	DRY	No.2
V - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
V - S	2x6	DRY	No.2
S - P	2x6	DRY	No.2
P - M	2x6	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.


DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C	12	SIDE(81.0)
C-G	12	SIDE(81.0)
G-J	12	SIDE(81.0)
J-L	12	SIDE(81.0)
V-B	12	TOP
M-K	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
V-S	12	SIDE(183.1)
S-P	12	SIDE(183.1)
P-M	12	SIDE(183.1)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

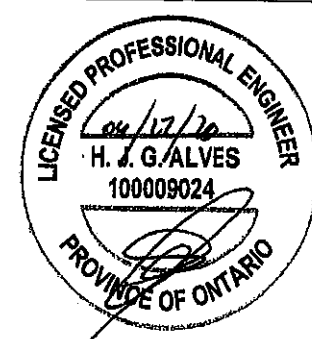

Structural component only
DWG# T-2007145 1/2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	UP	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
V	3342	0	3342	0	0	5-8	5-8	5-8	5-8
M	3393	0	3393	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		MAX/MIN COMPONENT REACTIONS	
1ST CASE	2ND CASE	1ST CASE	2ND CASE
JT	COMBINED	SNOW	LIVE
V	2363	1855 / 0	0 / 0
M	2397	1888 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS (LO)	MEMB.	FORCE (LBS)
FR-TO				FR-TO	
A-B	0 / 35	-91.8	-91.8 0.07 (1)	U-C	-598 / 0
B-C	-3951 / 0	-91.8	-91.8 0.22 (1)	C-T	0 / 3530
C-W	-8188 / 0	-91.8	-91.8 0.61 (1)	T-O	-1829 / 0
W-X	-8188 / 0	-91.8	-91.8 0.61 (1)	O-R	0 / 1802
X-Y	-8188 / 0	-91.8	-91.8 0.61 (1)	R-E	-802 / 0
Y-D	-8188 / 0	-91.8	-91.8 0.61 (1)	Q-H	-598 / 0
D-Z	-7502 / 0	-91.8	-91.8 0.71 (1)	Q-I	0 / 1573
Z-AA	-7502 / 0	-91.8	-91.8 0.71 (1)	O-I	-1808 / 0
AA-E	-7502 / 0	-91.8	-91.8 0.71 (1)	O-J	0 / 3493
EA-B	-7502 / 0	-91.8	-91.8 0.35 (1)	N-U	-818 / 0
AB-AC	-7502 / 0	-91.8	-91.8 0.35 (1)	B-U	0 / 3374
AC-F	-7502 / 0	-91.8	-91.8 0.35 (1)	N-K	0 / 3439
F-G	-7509 / 0	-91.8	-91.8 0.37 (1)	R-F	-179 / 0
G-H	-7509 / 0	-91.8	-91.8 0.37 (1)	F-Q	-188 / 0
H-AD	-7509 / 0	-91.8	-91.8 0.37 (1)		
AD-AE	-7509 / 0	-91.8	-91.8 0.71 (1)		
AE-AF	-7509 / 0	-91.8	-91.8 0.71 (1)		
AF-I	-7509 / 0	-91.8	-91.8 0.71 (1)		
I-AG	-8217 / 0	-91.8	-91.8 0.61 (1)		
AG-AH	-8217 / 0	-91.8	-91.8 0.61 (1)		
AH-J	-8217 / 0	-91.8	-91.8 0.61 (1)		
J-K	-4026 / 0	-91.8	-91.8 0.22 (1)		
K-L	0 / 35	-91.8	-91.8 0.07 (1)		
V-B	-3288 / 0	0.0	0.0 0.18 (1)		
M-K	-3356 / 0	0.0	0.0 0.18 (1)		

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.23")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/984 (0.44")

CSI: TC=0.71/1.00 (D-E:1), BC=0.58/1.00 (Q-R:1), WB=0.44/1.00 (C-T:1), SS=0.23/1.00 (O-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.71 (G) (INPUT = 0.90)
JSI METAL= 0.58 (S) (INPUT = 1.00)

JOB NAME 408169	TRUSS NAME T20	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:24 2020 Page 2	
				ID:K7TPdhoiUnp1tqYcbWIOFzIdG-i8ltasnl'sB7 Budbz0zKub4B6zN xr0MZbHOqzN8D	

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.50	3.50
C	TTWW-m	MT20	6.0	9.0	Edge 8.25	
D	TMVW-i	MT20	4.0	6.0		
E	TMVW-w	MT20	2.0	4.0		
F	TMVW-t	MT20	4.0	4.0		
G	TS-i	MT20	3.0	6.0		
H	TMVW-w	MT20	2.0	4.0		
I	TMVW-i	MT20	4.0	6.0		
J	TTWW-m	MT20	6.0	9.0	Edge 8.25	
K	TMVW-p	MT20	5.0	8.0	1.50	3.50
M	BMV-i-p	MT20	3.0	6.0		
N	BMVW-i	MT20	5.0	6.0	2.50	2.00
O	BMVW-t	MT20	6.0	9.0	4.50	2.00
P	BS-i	MT20	5.0	6.0		
Q	BMVWV-i	MT20	5.0	6.0		
R	BMVWV-t	MT20	6.0	6.0		
S	BS-i	MT20	5.0	6.0		
T	BMVW-i	MT20	6.0	6.0	4.50	2.00
U	BMVW-t	MT20	5.0	6.0	2.50	2.00
V	BMV-i-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
AS-AT	0 / 6217	-18.5	-18.5 0.46 (1)	10.00			
AT-O	0 / 6217	-18.5	-18.5 0.46 (1)	10.00			
O-AU	0 / 3326	-18.5	-18.5 0.26 (1)	10.00			
AU-AV	0 / 3326	-18.5	-18.5 0.26 (1)	10.00			
AV-N	0 / 3326	-18.5	-18.5 0.26 (1)	10.00			
N-AW	0 / 0	-18.5	-18.5 0.04 (4)	10.00			
AW-M	0 / 0	-18.5	-18.5 0.04 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)


JT	LOC.	LC1	MAX	MAX*	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-11	-49	-55	---	FRONT	VERT	DEAD	---	C1
C	4-0-11	-254	-254	---	FRONT	VERT	SNOW	---	C1
G	19-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
J	31-1-6	-40	-55	---	FRONT	VERT	DEAD	---	C1
J	31-1-6	-117	-117	---	BACK	VERT	TOTAL	---	C1
J	31-1-6	-254	-254	---	FRONT	VERT	SNOW	---	C1
N	31-2-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
P	21-2-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
W	5-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
X	7-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
Y	9-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
Z	11-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
AA	13-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
AB	15-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
AC	17-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
AD	19-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
AE	21-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
AF	23-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
AG	25-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
AH	27-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
AI	29-2-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
AJ	31-2-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
AK	33-2-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
AL	35-2-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
AM	37-2-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
AN	39-2-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
AO	41-2-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
AP	43-2-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
AQ	45-2-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
AR	47-2-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
AS	49-2-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
AT	51-2-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
AU	53-2-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
AV	55-2-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
AW	57-2-12	-28	-28	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007145

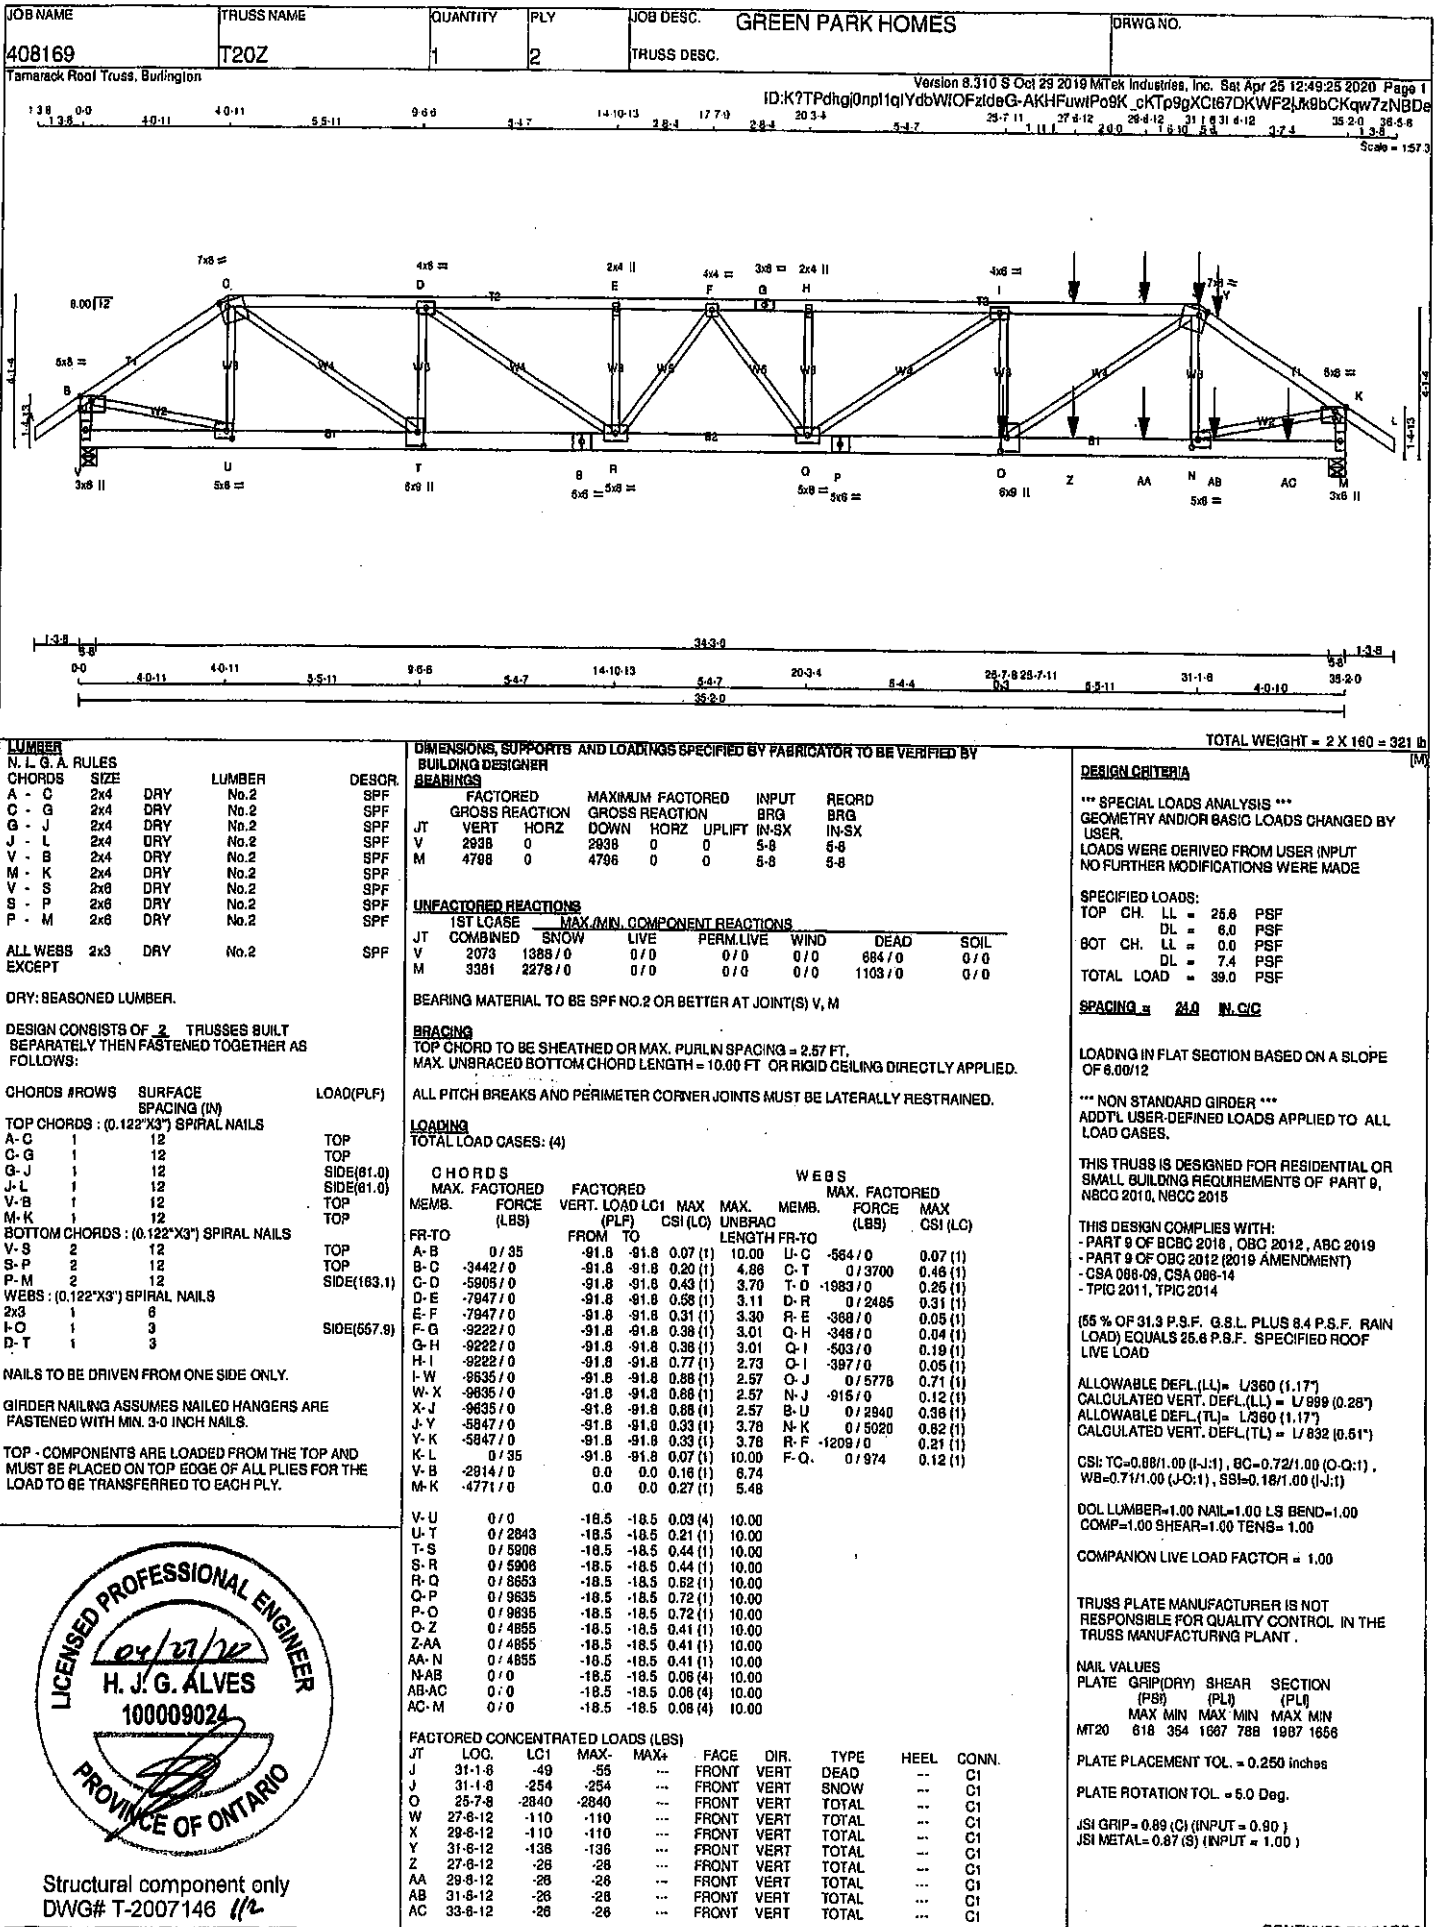

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T20Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 26 12:49:25 2020 Page 2 ID:K7TPdhaJ0np11qYobWIOFzIdeG-AKHFWuP0gK_cKTo9pXCi67DKWF2Jk9bCKqW7zNBDe			
		TRUSS DESC.			

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.50	3.50
C	TTWW-m	MT20	7.0	8.0	1.75	2.50
D	TMVW-t	MT20	4.0	6.0		
E	TMVW-w	MT20	2.0	4.0		
F	TMVW-t	MT20	4.0	4.0		
G	TS-t	MT20	3.0	8.0		
H	TMVW-w	MT20	2.0	4.0		
I	TMVW-t	MT20	4.0	8.0		
J	TTWW-m	MT20	7.0	8.0	1.75	2.50
K	TMVW-p	MT20	5.0	8.0	1.50	3.50
M	BMV1-p	MT20	3.0	6.0		
N	BMVW-t	MT20	5.0	6.0	2.50	2.00
O	BMVW-t	MT20	6.0	9.0	4.50	2.00
P	BS-t	MT20	5.0	6.0		
Q	BMVW-t	MT20	5.0	8.0		
R	BMVW-t	MT20	5.0	8.0		
S	BS-t	MT20	5.0	6.0		
T	BMVW-t	MT20	6.0	9.0	4.50	2.00
U	BMVW-t	MT20	5.0	6.0	2.50	2.00
V	BMV1-p	MT20	3.0	6.0		


CONNECTION REQUIREMENTS

- 1) Gt: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007146 42

JOB NAME 408169	TRUSS NAME T21	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MITK Industries, Inc. Sat Apr 26 12:49:26 2020 Page 1 ID:K?TPdhpj0np1q1YdbWOFzIdeG-eWrd5G2ZTSrDU10(O2RPJgONwdaSrJps4OSZzNBDD	

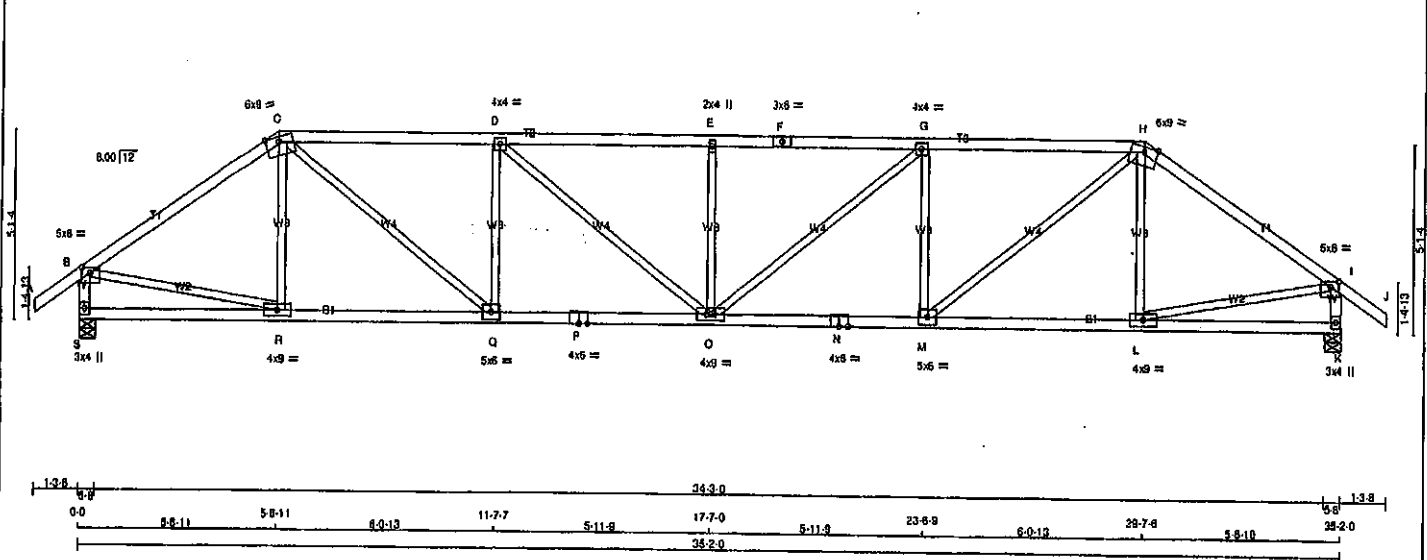

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
S - P	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2

EXCEPT

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.75	2.75
C	TTWW-m	MT20	6.0	9.0	Edge	
D	TMVW-l	MT20	4.0	4.0		
E	TMVW-w	MT20	2.0	4.0		
F	TS-l	MT20	3.0	6.0		
G	TMVW-l	MT20	4.0	4.0		
H	TTWW-m	MT20	6.0	9.0	Edge	
I	TMVW-p	MT20	5.0	8.0	1.75	2.75
K	BMV-l	MT20	3.0	4.0		
L	BMVW-l	MT20	4.0	9.0		
M	BMVW-l	MT20	5.0	6.0		
N	BS-l	MT20	4.0	8.0		
O	BMVW-w	MT20	4.0	9.0		
P	BS-l	MT20	4.0	8.0		
Q	BMVW-l	MT20	5.0	6.0		
R	BMVW-l	MT20	4.0	9.0		
S	BMV-l	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UPLIFT	IN-SX
S	2085	0	0	5-8
K	2085	0	0	5-8

UNFACTORED REACTIONS

JT	1ST LOSE	MAX/MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE	
S	1458	970 / 0	0 / 0	0 / 0	488 / 0
K	1458	970 / 0	0 / 0	0 / 0	488 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.97 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO	FROM TO	FROM TO	FROM TO
A-B	0 / 35	-91.8	-91.8
B-C	-2297 / 0	-91.8	-91.8
C-D	-3213 / 0	-91.8	-91.8
D-E	-3594 / 0	-91.8	-91.8
E-F	-3594 / 0	-91.8	-91.8
F-G	-3594 / 0	-91.8	-91.8
G-H	-3213 / 0	-91.8	-91.8
H-I	-2296 / 0	-91.8	-91.8
I-J	0 / 35	-91.8	-91.8
S-B	-2023 / 0	0.0	0.0
X-I	-2023 / 0	0.0	0.0
S-R	0 / 0	-18.5	-18.5
R-Q	0 / 1904	-18.5	-18.5
Q-P	0 / 3213	-18.5	-18.5
P-O	0 / 3213	-18.5	-18.5
O-N	0 / 3213	-18.5	-18.5
N-M	0 / 3213	-18.5	-18.5
M-L	0 / 1803	-18.5	-18.5
L-K	0 / 0	-18.5	-18.5

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	PSF
DL	25.8	PSF
BOT CH.	LL	PSF
DL	0.0	PSF
DL	7.4	PSF
TOTAL LOAD	39.0	PSF

SPACING = 24.0 IN. G/G

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2010, NBCO 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCO 2015, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")

CALCULATED VERT. DEFL. (LL) = L/999 (0.21")

ALLOWABLE DEFL. (TL) = L/360 (1.17")

CALCULATED VERT. DEFL. (TL) = L/999 (0.39")

CSI: TC=0.88/1.00 (E-G:1), BC=0.58/1.00 (O-Q:1), WB=0.44/1.00 (B-R:1), SSI=0.26/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (ORY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1687 788 1687 1688	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.67 (B) (INPUT = 0.90)

JSI METAL = 0.74 (P) (INPUT = 1.00)




Structural component only
DWG# T-2007147

JOB NAME 408169	TRUSS NAME T22	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:48:27 2020 Page 1
ID:K?TPdngj0npl1qlydbWIOFzIdG-8jO?JbugKnairecCH5ZgyXDemJ7DB8HS2Wpx77zNBDC

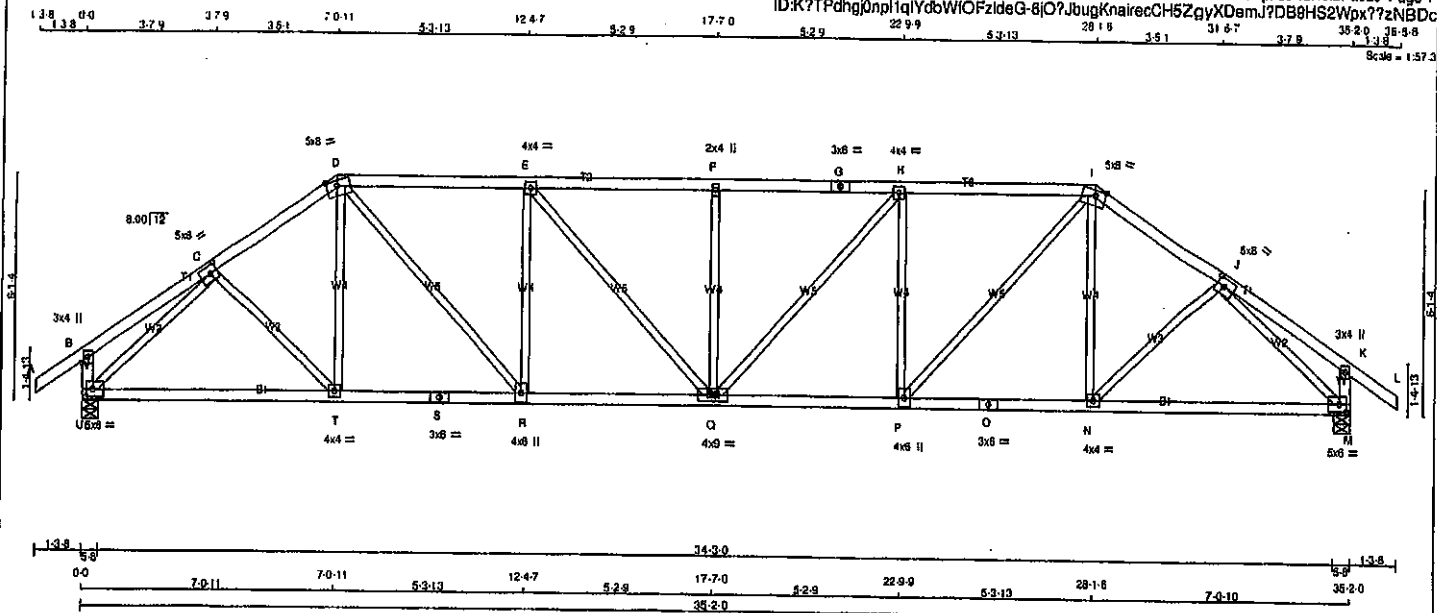

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
G - I	2x4	DRY	No.2	SPF	
I - L	2x4	DRY	No.2	SPF	
L - B	2x4	DRY	No.2	SPF	
M - K	2x4	DRY	No.2	SPF	
U - S	2x4	DRY	No.2	SPF	
S - O	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE	MT20	3.0	4.0	
B TMV+p	MT20	5.0	8.0	2.50 2.50
C TMWW-1	MT20	5.0	8.0	1.75 3.50
D TTWW-m	MT20	4.0	4.0	
E TMWW-1	MT20	2.0	4.0	
F TMW+w	MT20	3.0	6.0	
G TS-1	MT20	4.0	4.0	
H TMWW-1	MT20	5.0	8.0	1.75 3.50
I TTWW-m	MT20	5.0	8.0	2.50 2.50
J TMWW-1	MT20	3.0	4.0	
K TMV+p	MT20	5.0	8.0	2.50 2.25
M BMVW-1	MT20	4.0	4.0	
N BMWW-1	MT20	4.0	4.0	
O BS-1	MT20	3.0	6.0	
P BMVW+1	MT20	4.0	4.0	
Q BMVW-1	MT20	4.0	4.0	
R BMVW+1	MT20	3.0	6.0	
S BS-1	MT20	4.0	4.0	
T BMVW-1	MT20	5.0	8.0	2.50 2.25
U BMVW-1	MT20	5.0	8.0	2.50 2.25

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	IN-SX	IN-SX
U	2085	0	0	5-8
M	2085	0	0	5-8

UNFACTORED REACTIONS	1ST LOASE	MAX./MIN. COMPONENT REACTIONS
	COMBINED	SNOW
JT	1458	970/0
U	1458	970/0

BEARING MATERIAL TO BE 8PF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.53 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			WEBS					
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)	
FR-TO		FROM	TO	LENGTH	FR-TO			
A-B	0/35	-91.8	-91.8	0.12 (1)	10.00	C-T	0/135	0.03 (4)
B-C	0/18	-91.8	-91.8	0.16 (1)	10.00	T-D	0/90	0.03 (4)
C-D	-2305/0	-91.8	-91.8	0.23 (1)	4.31	D-R	0/1218	0.27 (1)
D-E	-2723/0	-91.8	-91.8	0.54 (1)	3.69	R-E	-814/0	0.48 (1)
E-F	-2868/0	-91.8	-91.8	0.58 (1)	3.53	E-Q	0/383	0.08 (1)
F-G	-2868/0	-91.8	-91.8	0.58 (1)	3.53	Q-F	-440/0	0.28 (1)
G-H	-2868/0	-91.8	-91.8	0.58 (1)	3.53	Q-H	0/383	0.08 (1)
H-I	-2723/0	-91.8	-91.8	0.54 (1)	3.69	P-H	-814/0	0.48 (1)
I-J	-2305/0	-91.8	-91.8	0.23 (1)	4.31	P-I	0/1218	0.27 (1)
J-K	0/18	-91.8	-91.8	0.16 (1)	10.00	N-I	0/90	0.03 (4)
K-L	0/39	-91.8	-91.8	0.12 (1)	10.00	N-J	0/138	0.03 (4)
L-M	-285/0	0.0	0.0	0.03 (1)	7.81	U-C	-2515/0	0.97 (1)
M-K	-285/0	0.0	0.0	0.03 (1)	7.81	J-M	-2514/0	0.97 (1)
U-T	0/1802	-18.5	-18.5	0.40 (1)	10.00			
T-S	0/1901	-18.5	-18.5	0.41 (1)	10.00			
S-R	0/1901	-18.5	-18.5	0.41 (1)	10.00			
R-Q	0/2724	-18.5	-18.5	0.49 (1)	10.00			
Q-P	0/2723	-18.5	-18.5	0.49 (1)	10.00			
P-O	0/1800	-18.5	-18.5	0.41 (1)	10.00			
O-N	0/1900	-18.5	-18.5	0.41 (1)	10.00			
N-M	0/1801	-18.5	-18.5	0.40 (1)	10.00			

TOTAL WEIGHT = 2 X 151 = 303 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/860 (1.17)
CALCULATED VERT. DEFL. (LL) = L/899 (0.16)
ALLOWABLE DEFL. (TL) = L/860 (1.17)
CALCULATED VERT. DEFL. (TL) = L/899 (0.28)

CSI: TC=0.58/1.00 (E-F:1), BC=0.48/1.00 (G-R:1),
WB=0.97/1.00 (C-U:1), SS=0.23/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1887 1858


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.90 (M) (INPUT = 0.90)
JSI METAL=0.93 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007148

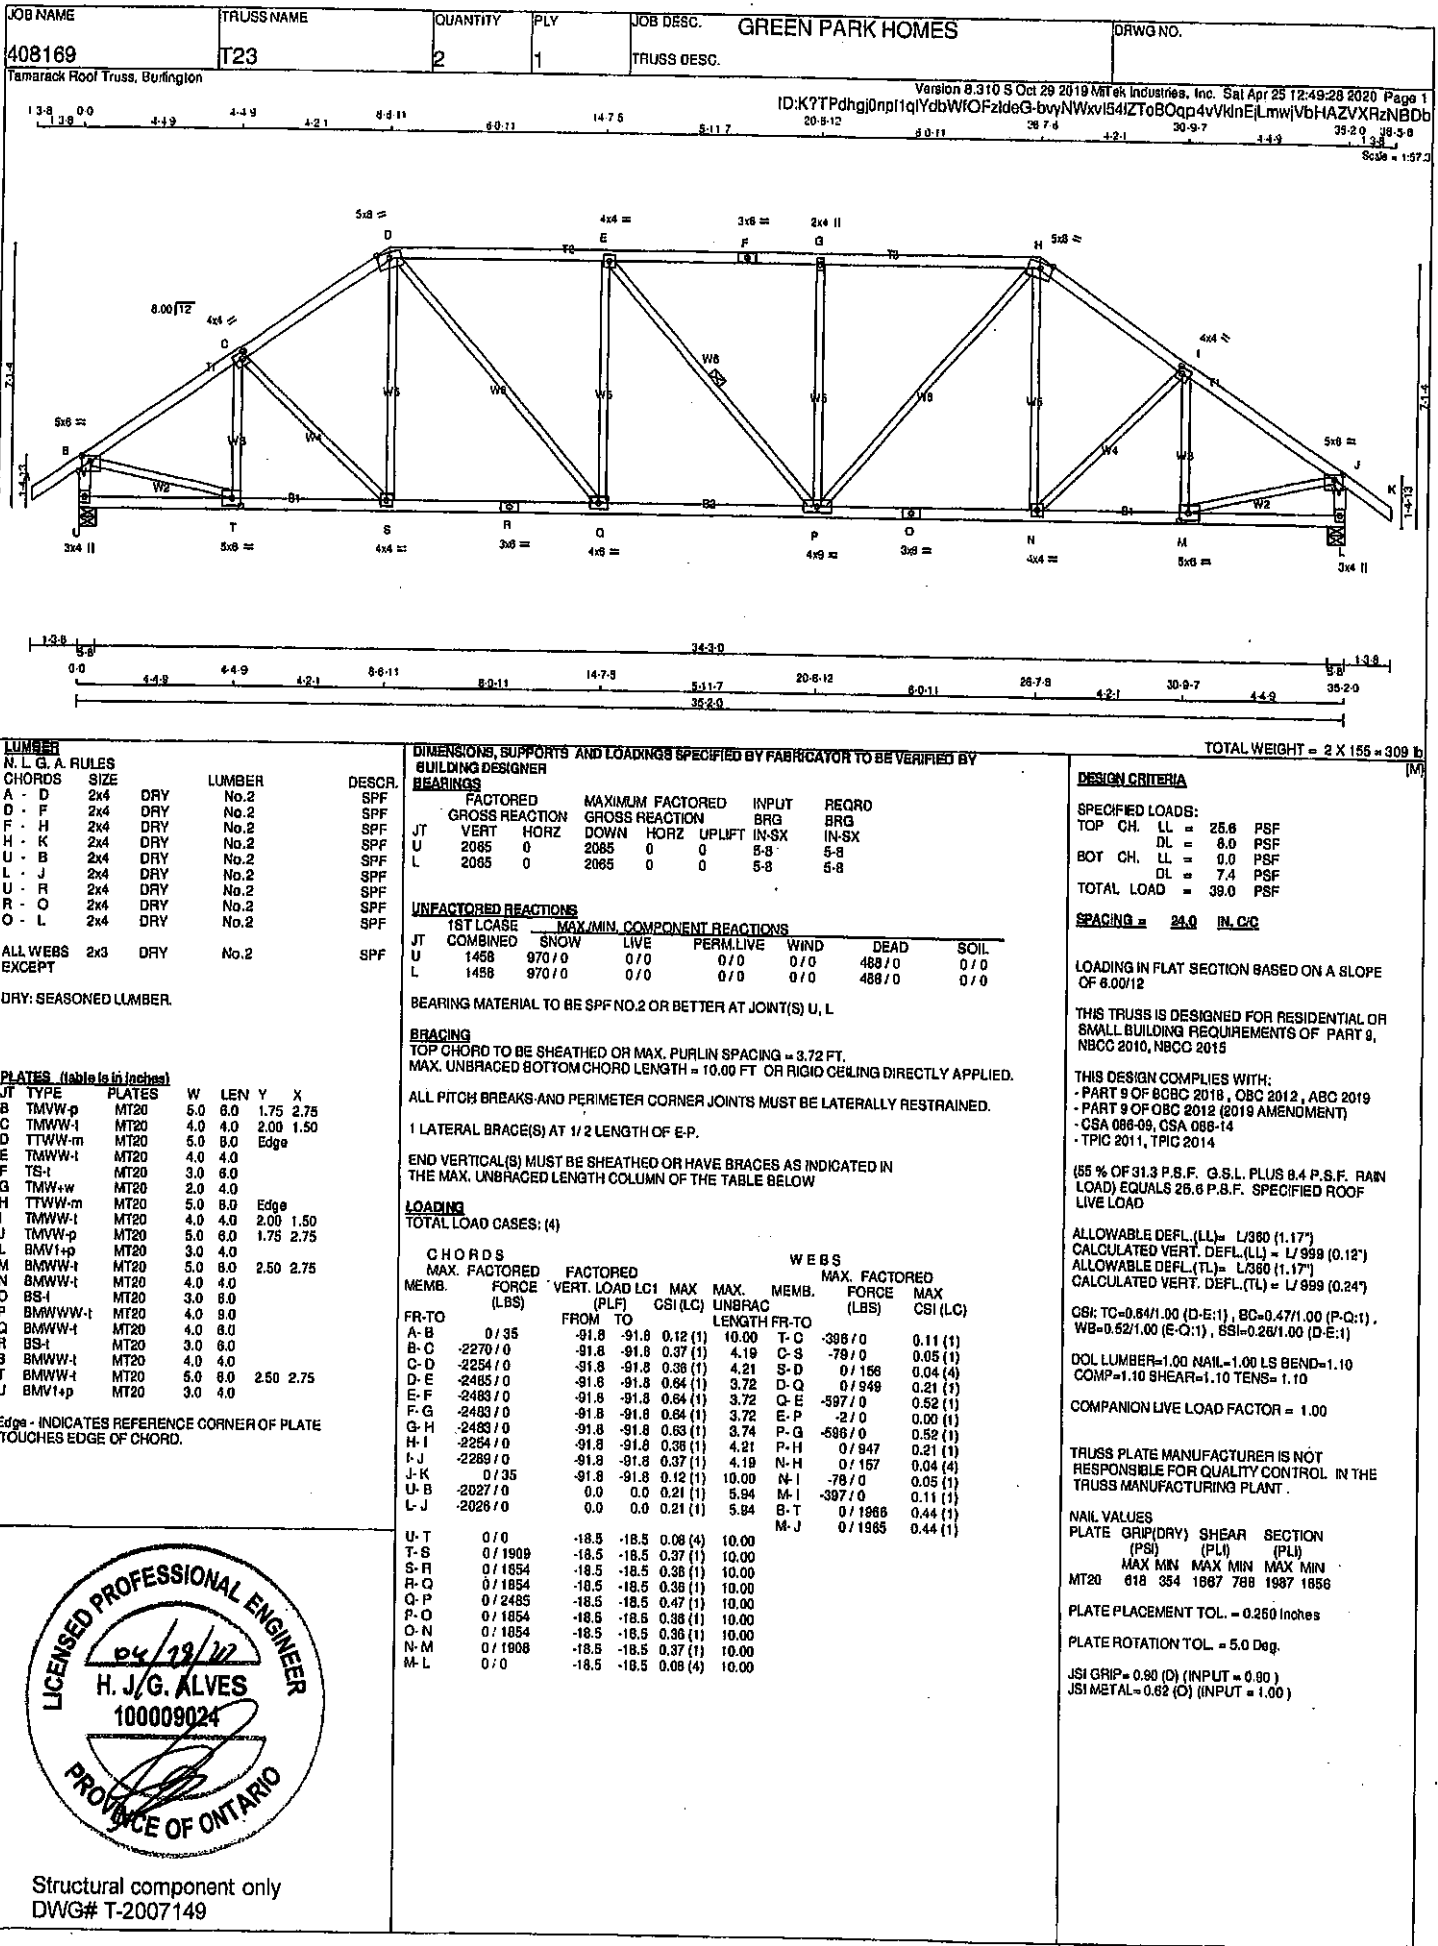

JOB NAME 408169	TRUSS NAME T24	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:20 2020 Page 1
ID:K7TPdhgJOnp1qYdbWIOFzdeG-35WmkHwvsOqC4ymbOWc81ylwH7ixfBiWql23uzNBda

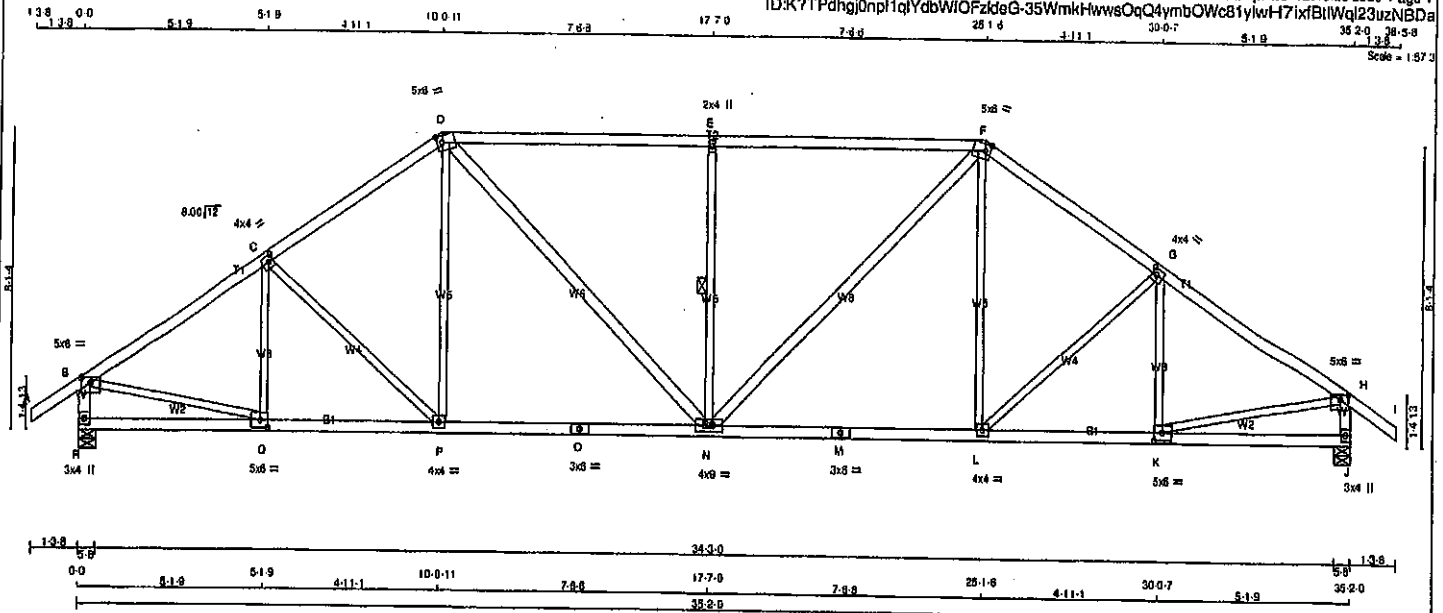

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - B	2x4	DRY	No.2
B - H	2x4	DRY	No.2
H - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY, SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.75	2.75
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TTWW-m	MT20	5.0	8.0	2.25	1.75
E	TMVW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	8.0	2.25	1.75
G	TMVW-t	MT20	4.0	4.0	2.00	1.50
H	TMVW-p	MT20	5.0	8.0	1.75	2.75
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-t	MT20	5.0	8.0	2.50	2.75
L	BMVW-t	MT20	4.0	4.0		
M	BS-t	MT20	3.0	8.0		
N	BMVWW-t	MT20	4.0	9.0		
O	BS-t	MT20	3.0	8.0		
P	BMVW-t	MT20	4.0	4.0		
Q	BMVWW-t	MT20	5.0	8.0	2.50	2.75
R	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	UP	BRG	BRG	IN-SX
R	2065	0	0	2065	0	0	5-8	5-8	
J	2085	0	0	2085	0	0	5-8	5-8	

UNFACTORED REACTIONS		1ST CASE		MAX/MIN COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
R	1458	970/0	0/0	0/0	488/0
J	1458	970/0	0/0	0/0	488/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE	VERT. LOAD	LC1 MAX	MEMB.	FORCE
FR-TO	(LBS)	FROM TO	CSI (LC)	FR-TO	(LBS)
A-B	0/35	-91.8	-91.8 0.12 (1)	C-C	-321/0
B-C	-2318/0	-91.8	-91.8 0.38 (1)	C-P	-218/0
C-D	-2188/0	-91.8	-91.8 0.37 (1)	P-D	0/256
D-E	-2274/0	-91.8	-91.8 0.81 (1)	D-N	0/691
E-F	-2274/0	-91.8	-91.8 0.81 (1)	N-E	-851/0
F-G	-2185/0	-91.8	-91.8 0.37 (1)	N-F	0/691
G-H	-2317/0	-91.8	-91.8 0.38 (1)	L-F	0/256
H-I	0/35	-91.8	-91.8 0.12 (1)	L-G	-218/0
I-B	-2022/0	0.0	0.0 0.21 (1)	K-G	-321/0
J-H	-2022/0	0.0	0.0 0.21 (1)	B-Q	0/1998
R-Q	0/0	-18.5	-18.5 0.10 (4)	K-H	0/1998
Q-P	0/1953	-18.5	-18.5 0.40 (1)		
P-O	0/1784	-18.5	-18.5 0.41 (1)		
O-N	0/1784	-18.5	-18.5 0.41 (1)		
N-M	0/1784	-18.5	-18.5 0.41 (1)		
M-L	0/1784	-18.5	-18.5 0.41 (1)		
L-K	0/1953	-18.5	-18.5 0.40 (1)		
K-J	0/0	-18.5	-18.5 0.10 (4)		

TOTAL WEIGHT = 2 X 158 = 317 b

(M/F)

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. G.C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/380 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSI: TC=0.81/1.00 (D-E:1), BC=0.41/1.00 (N-P:1), WB=0.45/1.00 (B-Q:1), SS=0.34/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.260 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (B) (INPUT = 0.80)
JSI METAL = 0.84 (M) (INPUT = 1.00)




Structural component only
DWG# T-2007150

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T25	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

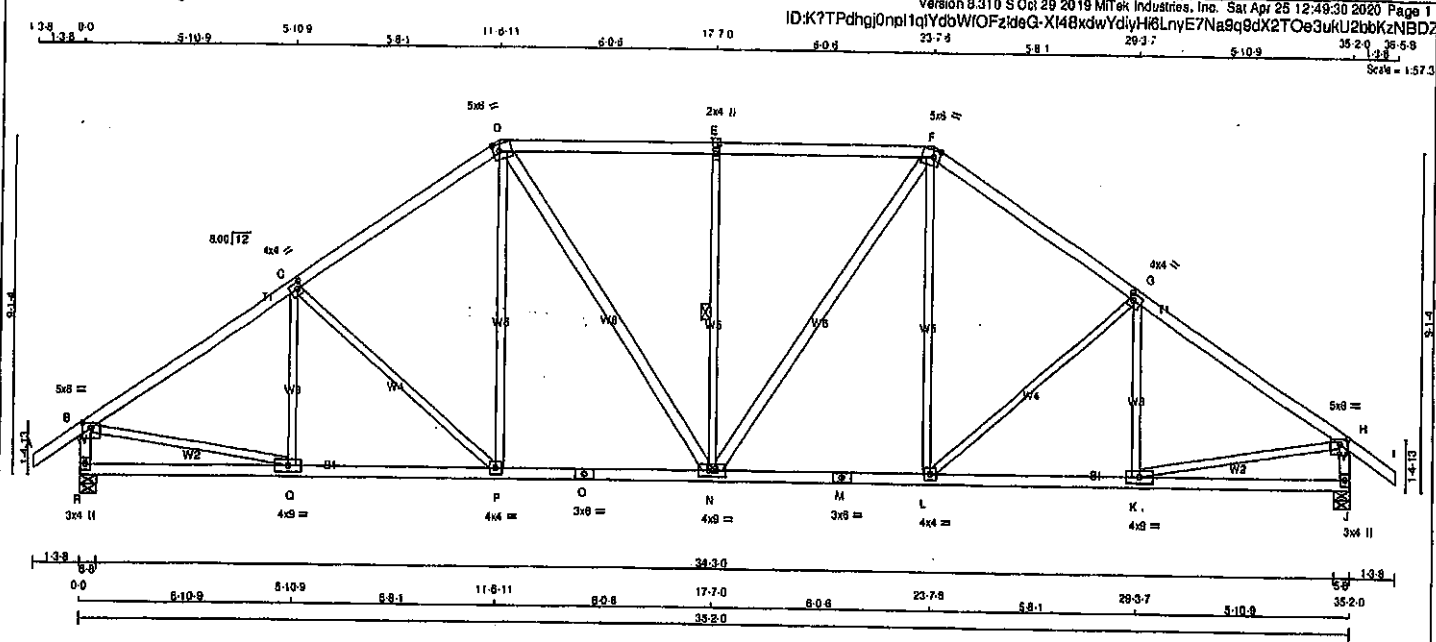

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				TOTAL WEIGHT = 2 X 165 = 329 lb					
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	SPF	FACTORED	MAXIMUM FACTORED	INPUT	REQD	DESIGN CRITERIA			
A - D	2x4	DRY	No.2	SPF		GROSS REACTION	MAXIMUM FACTORED	INPUT	REQD	SPECIFIED LOADS:			
D - F	2x4	DRY	No.2	SPF		JT VERT	DOWN	UP	BRG	TOP CH. LL = 25.6 PSF			
F - I	2x4	DRY	No.2	SPF		R 2065	0	0	5-8	OL = 8.0 PSF			
R - B	2x4	DRY	No.2	SPF		J 2065	0	0	5-8	BOT CH. LL = 0.0 PSF			
J - H	2x4	DRY	No.2	SPF						DL = 7.4 PSF			
R - O	2x4	DRY	No.2	SPF						TOTAL LOAD = 39.0 PSF			
O - M	2x4	DRY	No.2	SPF						SPACING = 24.0 IN/C			
M - J	2x4	DRY	No.2	SPF						LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12			
ALL WEBS	2x3	DRY	No.2	SPF						THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015			
EXCEPT										THIS DESIGN COMPLIES WITH:			
D - N	2x4	DRY	No.2	SPF						- PART 9 OF CBC 2010, CBC 2012, ABC 2019			
N - F	2x4	DRY	No.2	SPF						- PART 9 OF CBC 2012 (2019 AMENDMENT)			
DRY: SEASONED LUMBER.				BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J				- CSA 086-09, CSA 086-14					
				BRACING				- TPIC 2011, TPIC 2014					
				TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.99 FT.				(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD					
				MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.				ALLOWABLE DEFL. (LL) = L/360 (1.17')					
				ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.				CALCULATED VERT. DEFL. (LL) = L/999 (0.10')					
				END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW				ALLOWABLE DEFL. (TL) = L/360 (1.17')					
				LOADING				CALCULATED VERT. DEFL. (TL) = L/999 (0.10')					
				TOTAL LOAD CASES: (4)				CSI: TC=0.52/1.00 (B-C:1), BC=0.39/1.00 (P-Q:1), WB=0.48/1.00 (B-Q:1), SS=0.27/1.00 (D-E:1)					
				CHORDS				DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10					
				MEMB. MAX. FACTORED FORCE (LBS)				COMP=1.10 SHEAR=1.10 TENS=1.10					
				VERT. LOAD (PLF)				COMpanion LIVE LOAD FACTOR = 1.00					
				MAX. FACTORED FORCE (LBS)				TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT					
				MAX. FACTORED FORCE (LBS)				NAIL VALUES					
				MAX. FACTORED FORCE (LBS)				PLATE GRP(DRY) SHEAR SECTION					
				MAX. FACTORED FORCE (LBS)				(PSI) (PLI) (PLI)					
				MAX. FACTORED FORCE (LBS)				MAX MIN MAX MIN MAX MIN					
				MAX. FACTORED FORCE (LBS)				MT20 818 354 1687 788 1987 1686					
				MAX. FACTORED FORCE (LBS)				PLATE PLACEMENT TOL. = 0.260 inches					
				MAX. FACTORED FORCE (LBS)				PLATE ROTATION TOL. = 5.0 Deg.					
				MAX. FACTORED FORCE (LBS)				JSI GRP= 0.87 (B) (INPUT = 0.90)					
				MAX. FACTORED FORCE (LBS)				JSI METAL= 0.58 (M) (INPUT = 1.00)					

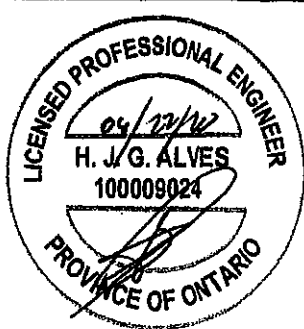


Structural component only
DWG# T-2007151

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408169	T26	5	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 12:49:32 2020 Page 1

ID:K?T?Pdhgij0npl1qYdbWIOFzIdaG-TgCuMjy8JC7yPVA3e9rlawTUKJTsYXBCoXlgDzNBDX

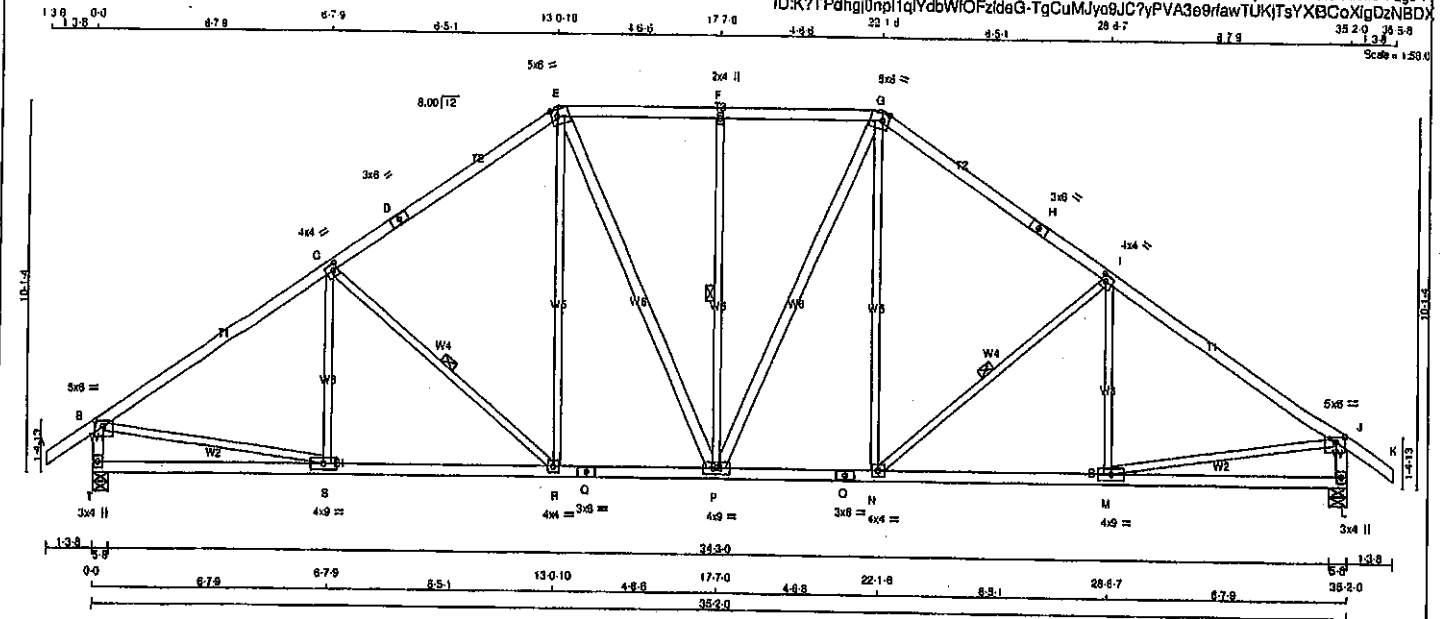

LUMBER	CHORDS	SIZE	DRY	LUMBER
N. L. G. A. RULES				
A - D	2x4	DRY	No.2	
E - H	2x4	DRY	No.2	
G - H	2x4	DRY	No.2	
H - K	2x4	DRY	No.2	
T - B	2x4	DRY	No.2	
L - J	2x4	DRY	No.2	
T - Q	2x4	DRY	No.2	
Q - O	2x4	DRY	No.2	
O - L	2x4	DRY	No.2	
ALL WEBS	2x3	DRY	No.2	
EXCEPT				
E - P	2x4	DRY	No.2	
P - G	2x4	DRY	No.2	

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TS-I	MT20	3.0	6.0		
E	TTWW-m	MT20	5.0	6.0	2.25	2.00
F	TMVW-w	MT20	2.0	4.0		
G	TTWW-m	MT20	5.0	6.0	2.25	2.00
H	TS-I	MT20	3.0	6.0		
I	TMVW-t	MT20	4.0	4.0	2.00	1.50
J	TMVW-p	MT20	5.0	6.0	1.75	2.75
L	BMV1+p	MT20	3.0	4.0		
M	BMVW-I	MT20	4.0	9.0		
N	BMVW-I	MT20	4.0	4.0		
O	BS-I	MT20	3.0	6.0		
P	BMVW-I	MT20	4.0	9.0		
Q	BS-I	MT20	3.0	6.0		
R	BMVW-I	MT20	4.0	4.0		
S	BMVW-I	MT20	4.0	9.0		
T	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED		MAXIMUM FACTORED			INPUT	REQRD
	GROSS REACTION		GROSS REACTION			BRG	BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
T	2085	0	2085	0	0	5-8	5-8
L	2085	0	2085	0	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LGAGE	MAX/MIN COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
T	COMBINED	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	COMBINED	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-R, F-P, I-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 / 35	-91.8 -91.8 0.12 (1)	10.00	S-C -189 / 48 0.10 (1)
B-C	-2359 / 0	-91.8 -91.8 0.69 (1)	3.77	C-R -485 / 0 0.24 (1)
C-D	-1896 / 0	-91.8 -91.8 0.62 (1)	4.11	R-E 0 / 416 0.08 (1)
D-E	-1896 / 0	-91.8 -91.8 0.82 (1)	4.11	E-P 0 / 315 0.05 (1)
E-F	-1781 / 0	-91.8 -91.8 0.27 (1)	4.77	P-F -502 / 0 0.35 (1)
F-G	-1781 / 0	-91.8 -91.8 0.27 (1)	4.77	P-G 0 / 315 0.05 (1)
G-H	-1896 / 0	-91.8 -91.8 0.62 (1)	4.11	N-G 0 / 415 0.09 (1)
H-I	-1896 / 0	-91.8 -91.8 0.62 (1)	4.11	N-I -484 / 0 0.24 (1)
I-J	-2359 / 0	-91.8 -91.8 0.69 (1)	3.77	M-I -189 / 48 0.10 (1)
J-K	0 / 35	-91.8 -91.8 0.12 (1)	10.00	B-S 0 / 2022 0.45 (1)
T-B	-2014 / 0	0.0 0.0 0.21 (1)	5.95	M-J 0 / 2021 0.45 (1)
L-J	-2014 / 0	0.0 0.0 0.21 (1)	5.95	
T-S	0 / 0	-18.5 -18.5 0.19 (4)	10.00	
S-R	0 / 1996	-18.5 -18.5 0.42 (1)	10.00	
R-Q	0 / 1829	-18.5 -18.5 0.32 (1)	10.00	
Q-P	0 / 1829	-18.5 -18.5 0.32 (1)	10.00	
P-O	0 / 1829	-18.5 -18.5 0.32 (1)	10.00	
O-N	0 / 1829	-18.5 -18.5 0.32 (1)	10.00	
N-M	0 / 1995	-18.5 -18.5 0.42 (1)	10.00	
M-L	0 / 0	-18.5 -18.5 0.19 (4)	10.00	

TOTAL WEIGHT = 5 X 172 = 856 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019

- PART 9 OF OBC 2012 (2019 AMENDMENT)

- CSA 088-09, CSA 086-14

- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")

CALCULATED VERT. DEFL. (LL) = L/999 (0.09")

ALLOWABLE DEFL. (TL) = L/360 (1.17")

CALCULATED VERT. DEFL. (TL) = L/999 (0.18")

CSK: TC=0.89/1.00 (B-C:1), BC=0.42/1.00 (R-S:1),

WB=0.45/1.00 (B-S:1), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 616 354 1667 788 1997 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (B) (INPUT = 0.90)


JSI METAL= 0.50 (O) (INPUT = 1.00)

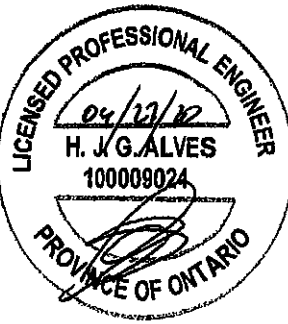

Structural component only
DWG# T-2007152

JOB NAME 408169	TRUSS NAME T27	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S.O. 29 2019 Matek Industries, Inc. Sat Apr 25 12:49:33 2020 Page 1
ID:K7TPdhgJOnplqYdbWIOF2IdeG-xlmGZfzRwdKrZZ4MdMq4CoSb3k2Cb7nKQSHGCFzNBWDW

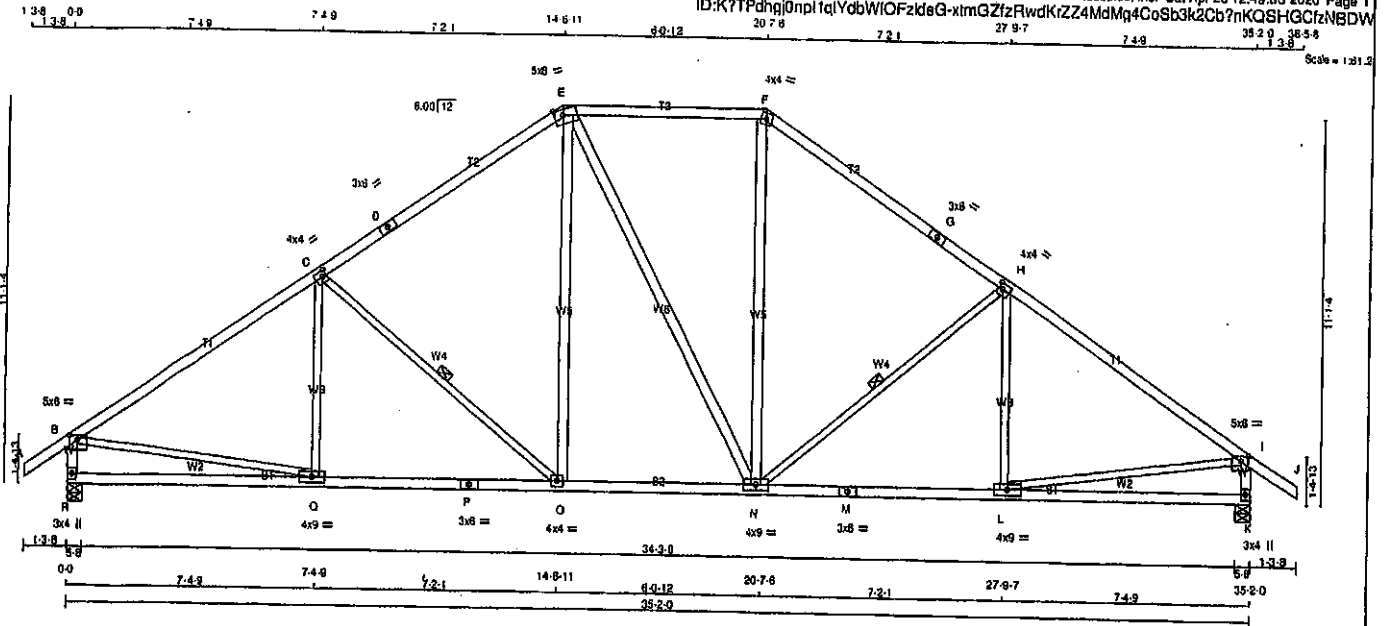

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
G - J	2x4	DRY	No.2	SPF
J - B	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
R - P	2x4	DRY	No.2	SPF
P - M	2x4	DRY	No.2	SPF
M - K	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
O - E	2x4	DRY	No.2	SPF
E - N	2x4	DRY	No.2	SPF
N - F	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	6.0	1.75	2.75
C	TMWV-1	MT20	4.0	4.0	2.00	1.50
D	TS-1	MT20	3.0	8.0		
E	TTWV-m	MT20	5.0	8.0	2.00	3.00
F	TTW-m	MT20	4.0	4.0		
G	TS-1	MT20	3.0	8.0		
H	TMWV-1	MT20	4.0	4.0	2.00	1.50
I	TMWV-p	MT20	5.0	6.0	1.75	2.75
K	BMV1-p	MT20	3.0	4.0		
L	BMWV-1	MT20	4.0	9.0		
M	BS-1	MT20	3.0	8.0		
N	BMWV-1	MT20	4.0	9.0		
O	BMWV-1	MT20	4.0	4.0		
P	BS-1	MT20	3.0	8.0		
Q	BMWV-1	MT20	4.0	9.0		
R	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
R	2085	0	2085	0	5-8
K	2085	0	2085	0	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1458	970/0	0/0	0/0	0/0	0/0	488/0	0/0
K	1458	970/0	0/0	0/0	0/0	0/0	488/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.45 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO	
A-B	0/35	-91.8	-91.8 0.12 (1)	Q-C	-139/78
B-C	-2358/0	-91.8	-91.8 0.89 (1)	C-O	-805/0
C-D	-1888/0	-91.8	-91.8 0.78 (1)	O-E	0/488
D-E	-1888/0	-91.8	-91.8 0.78 (1)	E-N	0/0
E-F	-1538/0	-91.8	-91.8 0.47 (1)	N-F	0/800
F-G	-1888/0	-91.8	-91.8 0.78 (1)	N-H	-604/0
G-H	-1888/0	-91.8	-91.8 0.78 (1)	H-L	-140/75
H-I	-2357/0	-91.8	-91.8 0.89 (1)	B-Q	0/2020
I-J	0/35	-91.8	-91.8 0.12 (1)	L-I	0/2019
R-B	-2069/0	0.0	0.0 0.21 (1)		
K-I	-2069/0	0.0	0.0 0.21 (1)		
R-Q	0/0	-18.5	-18.5 0.25 (4)		
Q-P	0/1999	-18.5	-18.5 0.45 (1)		
P-O	0/1999	-18.5	-18.5 0.45 (1)		
O-N	0/1838	-18.5	-18.5 0.33 (1)		
N-M	0/1998	-18.5	-18.5 0.45 (1)		
M-L	0/1898	-18.5	-18.5 0.45 (1)		
L-K	0/0	-18.5	-18.5 0.24 (4)		

TOTAL WEIGHT = 2 X 188 = 333 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

(85% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = L/999 (0.09)
ALLOWABLE DEFL.(TL) = L/360 (1.17)
CALCULATED VERT. DEFL.(TL) = L/999 (0.20)

CSI: TC=0.89/1.00 (B-C-I), BC=0.45/1.00 (C-Q-I), WB=0.45/1.00 (B-C-I), SB=0.27/1.00 (B-C-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.90 (F) (INPUT = 0.90)
JSI METAL = 0.88 (F) (INPUT = 1.00)



Structural component only
DWG# T-2007153

JOB NAME 408169	TRUSS NAME T28	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 12:49:34 2020 Page 1
ID:K?TPdhgJOnp1tqYdbWOFzIdeG-P3Jm?_3gwsIBjYB3Bjk77uz8RBKVUIU80pISzNBdV

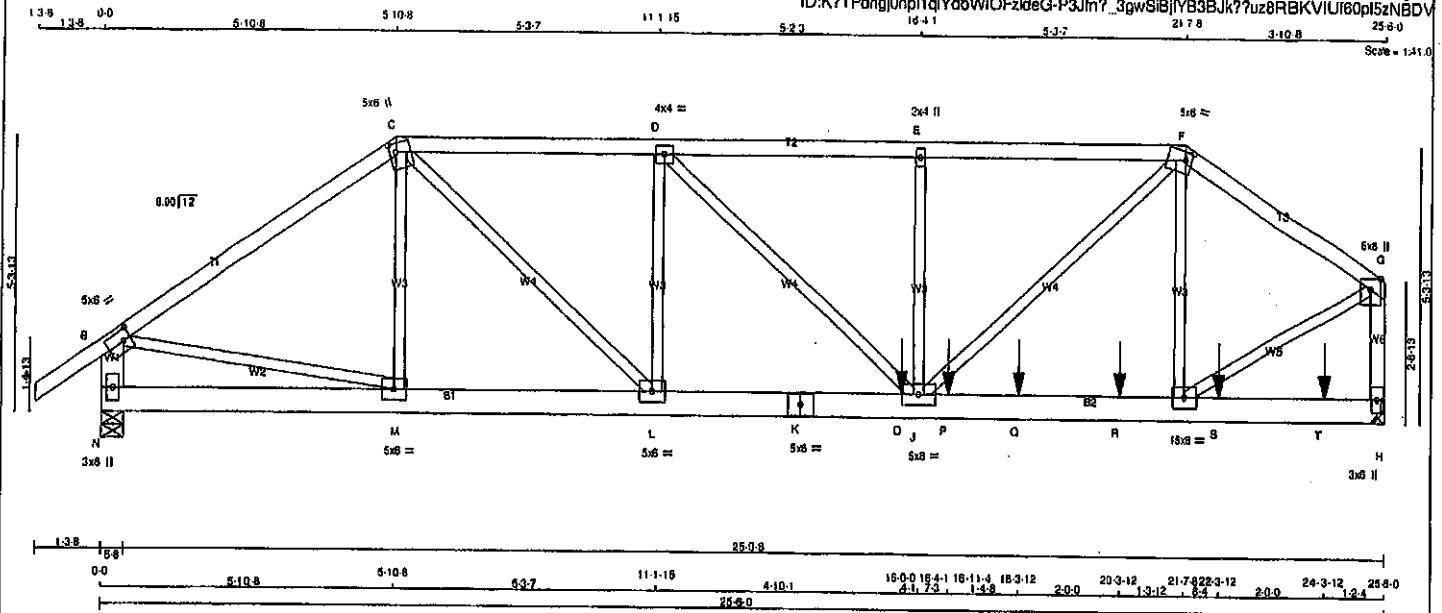

LUMBER	SIZE	DRY	NO.2	DESCR.
CHORDS	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
C - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
N - B	2x6	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF
N - K	2x6	DRY	No.2	SPF
K - H	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.
DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122'X3') SPIRAL NAILS		
A - C	12	TOP
C - F	12	TOP
F - G	12	TOP
H - G	12	TOP
N - B	12	TOP
BOTTOM CHORDS : (0.122'X3') SPIRAL NAILS		
N - K	12	TOP
K - H	12	TOP
WEBS : (0.122'X3') SPIRAL NAILS		
E - J	8	SIDE (183.1)
2x3	8	SIDE (77.0)

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.
TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.
SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	UPLIFT
N	2088	0	2088	0
H	2758	0	2758	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS	1ST CASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	SNOW
N	1470	994 / 0
H	1941	1320 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.78 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO			FR-TO	
A - B	0 / 35	-91.8	M - C	-218 / 22
B - C	-2383 / 0	-91.8	C - L	0 / 1550
C - D	-3093 / 0	-91.8	L - D	-928 / 0
D - E	-3519 / 0	-91.8	D - J	0 / 589
E - F	-3519 / 0	-91.8	J - F	-508 / 0
F - G	-2352 / 0	-91.8	F - J	0 / 2156
N - B	-2037 / 0	0.0	I - F	-548 / 0
H - G	-2632 / 0	0.0	B - M	0 / 1991
			I - G	0 / 2284
N - M	0 / 0	-18.5		
M - L	0 / 1859	-18.5		
L - K	0 / 3093	-18.5		
K - O	0 / 3093	-18.5		
O - J	0 / 3093	-18.5		
J - P	0 / 1942	-18.5		
P - Q	0 / 1942	-18.5		
Q - R	0 / 1942	-18.5		
R - I	0 / 1942	-18.5		
I - S	0 / 0	-18.5		
S - T	0 / 0	-18.5		
T - H	0 / 0	-18.5		

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
O	16-0-0	-987	-987	---	---	FRONT	VERT	TOTAL	---	C1
P	16-11-4	-187	-187	---	---	FRONT	VERT	TOTAL	---	C1
Q	16-3-12	-187	-187	---	---	FRONT	VERT	TOTAL	---	C1
R	20-3-12	-187	-187	---	---	FRONT	VERT	TOTAL	---	C1
S	22-3-12	-174	-174	---	---	FRONT	VERT	TOTAL	---	C1
T	24-3-12	-173	-173	---	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS
1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
BOT CH. LL = 6.0 PSF
DL = 0.0 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.85')
CALCULATED VERT. DEFL.(LL) = L/999 (0.06')
ALLOWABLE DEFL.(TL) = L/360 (0.85')
CALCULATED VERT. DEFL.(TL) = L/999 (0.11')

CSI: TC=0.37/1.00 (B-C:1), BC=0.27/1.00 (J-L:1), WB=0.28/1.00 (G-I:1), SS=0.34/1.00 (J-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (P) SHEAR SECTION (PS) (PL) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (F) (INPUT = 0.90)
JSI METAL = 0.45 (G) (INPUT = 1.00)



Structural component only
DWG# T-2007154 1/2


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T28	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 6 Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:49:34 2020 Page 2
ID:K?TPdhoI0npl1qlYdbWlOFzIdaG-P3Jln? 3qwsIBIfYB3BJk7?uz8R8KVIUf60qI5zNBDV

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-I	MT20	5.0	8.0	2.50	1.75
C	TTWW-m	MT20	5.0	8.0	2.00	1.50
D	TMWW-I	MT20	4.0	4.0		
E	TMW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	8.0	2.00	1.50
G	TMVW-p	MT20	5.0	8.0	Edge	
H	BMV1-p	MT20	3.0	6.0		
I, L, M						
I	BMWW-I	MT20	5.0	8.0		
J	BMWWW-I	MT20	5.0	8.0		
K	BS-I	MT20	5.0	8.0		
N	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

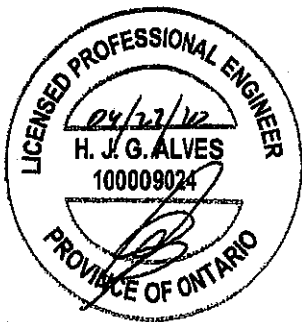

Structural component only
DWG# T-2007154 *mv*

JOB NAME 408169	TRUSS NAME T29	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRAUSS DESC.		Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 26 12:49:35 2020 Page 1	

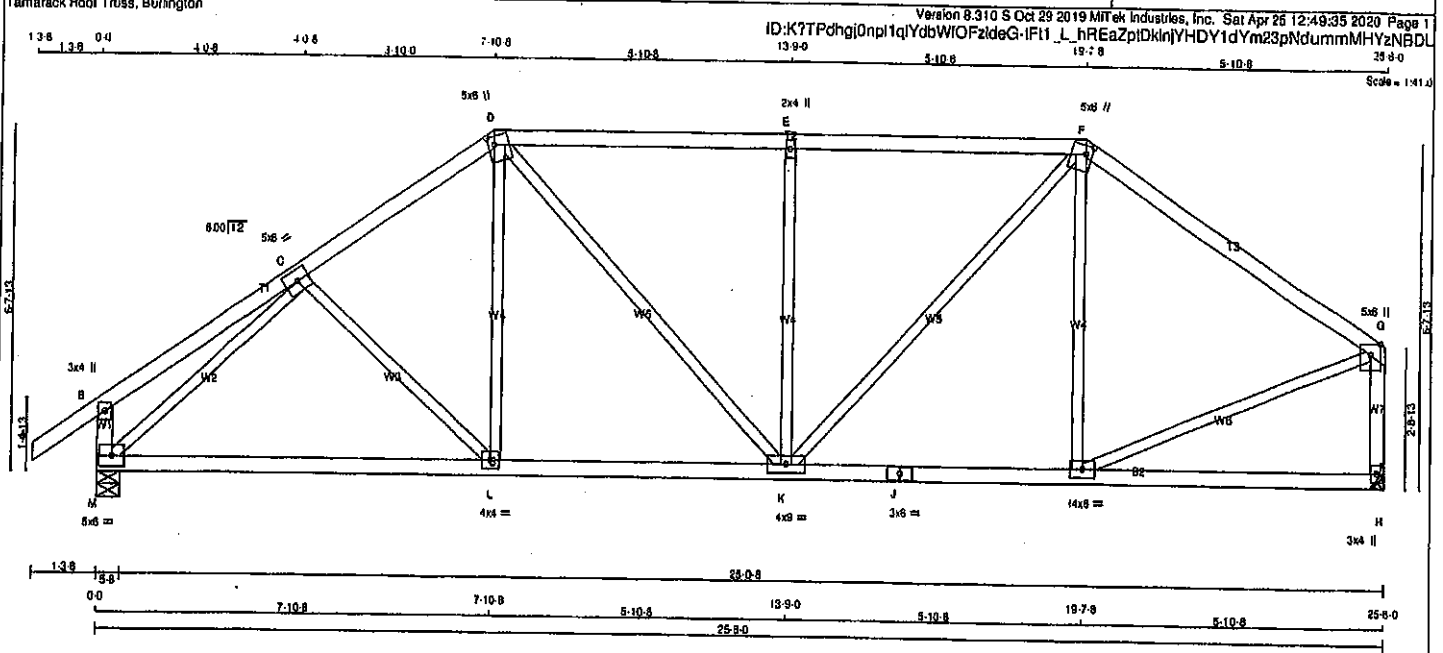

LUMBER				TOTAL WEIGHT = 109 lb			
N. L. G. A. RULES				BUILDING DESIGNER			
CHORDS	SIZE	LUMBER	DESCR.	BEARINGS			
A - D	2x4	DRY	No.2	FACTORED			
D - F	2x4	DRY	No.2	GROSS REACTION			
F - G	2x4	DRY	No.2	JT	VERT	HORIZ	DOWN
M - B	2x4	DRY	No.2	M	1532	0	1532
H - G	2x4	DRY	No.2	H	1408	0	1408
M - J	2x4	DRY	No.2	MECHANICAL			
J - H	2x4	DRY	No.2	A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3'-8".			
ALL WEBS	2x3	DRY	No.2	UNFACTORED REACTIONS			
EXCEPT			SPF	1ST CASE			
DRY: SEASONED LUMBER.				JT	COMBINED	SNOW	LIVE
				M	1081	723 / 0	0 / 0
				H	984	652 / 0	0 / 0

PLATES (table is in inches)				DESIGN CRITERIA			
JT	TYPE	PLATES	W	LEN	Y	X	
B	TMV+p	MT20	3.0	4.0			
C	TMVW-i	MT20	5.0	8.0			
D	TTWW+m	MT20	5.0	8.0	2.00	1.50	
E	TTWW+m	MT20	2.0	4.0			
F	TTWW+m	MT20	5.0	8.0	2.00	1.50	
G	TMVW+p	MT20	3.0	4.0			
H	BMV1+p	MT20	4.0	8.0			
I	BMVW-i	MT20	4.0	8.0			
J	BS-i	MT20	3.0	8.0			
K	BMVW-i	MT20	4.0	8.0			
L	BMVW-i	MT20	4.0	8.0			
M	BMVW-i	MT20	5.0	8.0			


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.89 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD	LO1 MAX	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED	
FR-TO	FROM	TO	CSI (LC)	FR-TO	FROM	TO	CSI (LC)
A-B	0 / 35	-91.8	-91.8 0.12 (1)	C-L	-80 / 27	0.04 (1)	
B-C	0 / 22	-91.8	-91.8 0.22 (1)	L-D	0 / 209	0.05 (4)	
C-D	-1491 / 0	-91.8	-91.8 0.19 (1)	D-K	0 / 354	0.08 (1)	
D-E	-1494 / 0	-91.8	-91.8 0.44 (1)	K-E	-882 / 0	0.48 (1)	
E-F	-1484 / 0	-91.8	-91.8 0.44 (1)	F-F	0 / 663	0.16 (1)	
F-G	-1228 / 0	-91.8	-91.8 0.44 (1)	I-F	-282 / 0	0.21 (1)	
M-B	-288 / 0	0.0	0.0 0.03 (1)	M-C	-1767 / 0	0.83 (1)	
H-G	-1382 / 0	0.0	0.0 0.20 (1)	I-G	0 / 1098	0.25 (1)	
M-L	0 / 1279	-18.5	-18.5 0.38 (4)				
L-K	0 / 1223	-18.5	-18.5 0.38 (4)				
K-J	0 / 1014	-18.5	-18.5 0.29 (1)				
J-I	0 / 1014	-18.5	-18.5 0.29 (1)				
I-H	0 / 0	-18.5	-18.5 0.17 (4)				

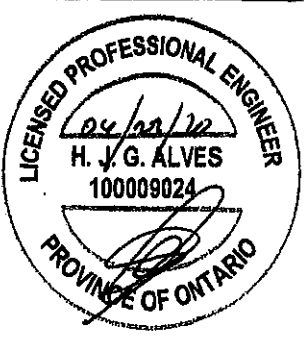

Structural component only
DWG# T-2007155

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 8 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPOC 2011, TPOC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.85")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.85")
CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.44/1.00 (F-G:1), BC=0.38/1.00 (K-L:4), WB=0.83/1.00 (C-M:1), SSI=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1887 1858

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.82 (D) (INPUT = 0.90)
JSI METAL = 0.51 (G) (INPUT = 1.00)

JOB NAME 408169	TRUSS NAME T30	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mark Industries, Inc. Sat Apr 25 12:49:38 2020 Page 1
ID:K?TPdngj0npl1qlydbWOFzIdeG-MSRPCg?JCYIQQ10xIUEnpQ4FSy9zoKVn7QVwp_zNBDT

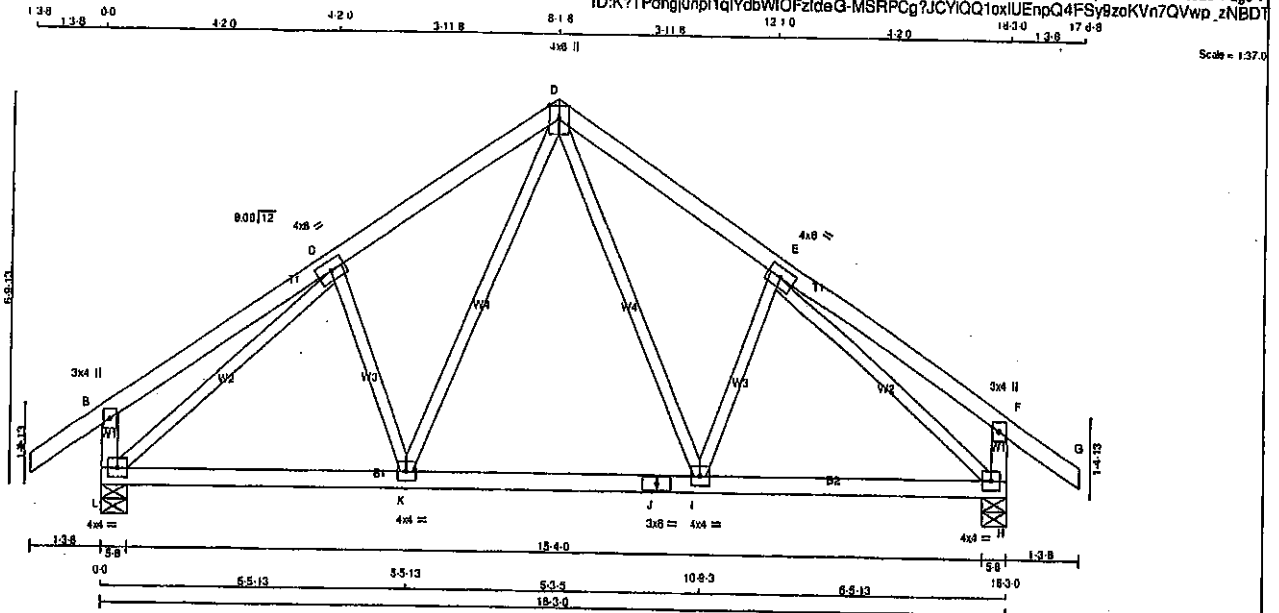

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2

ALL WEBS EXCEPT 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-i	MT20	4.0	8.0		
D	TTWW+p	MT20	4.0	8.0	Edge	
E	TMWW-i	MT20	4.0	8.0		
F	TMV+p	MT20	3.0	4.0		
H	BMVW-i	MT20	4.0	4.0		
I	BMVW-i	MT20	4.0	4.0		
J	BS-i	MT20	3.0	8.0		
K	BMVW-i	MT20	4.0	4.0		
L	BMVW-i	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED				MAXIMUM FACTORED			
GROSS REACTION				GROSS REACTION			
JT	VERT	HORZ	DOWN	JT	VERT	HORZ	DOWN
L	1022	0	1022	0	0	0	5-8
H	1022	0	1022	0	0	0	5-8

UNFACTORED REACTIONS							
1ST LOASE MAX/MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	720	488 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0
H	720	488 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	VERT. LOAD	MAX. FACTORED	MEMB.	MAX. FACTORED	VERT. LOAD	MAX. FACTORED
	(LBS)	(PLF)	OSI (LC)		(LBS)	(PLF)	OSI (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	D-I	0 / 338	0.08 (1)
B-C	0 / 24	-91.8	-91.8 0.24 (1)	10.00	I-E	-217 / 0	0.08 (1)
C-D	-845 / 0	-91.8	-91.8 0.19 (1)	6.25	K-D	0 / 338	0.08 (1)
D-E	-845 / 0	-91.8	-91.8 0.19 (1)	6.25	C-K	-217 / 0	0.08 (1)
E-F	0 / 24	-91.8	-91.8 0.24 (1)	10.00	L-G	-1042 / 0	0.52 (1)
F-G	0 / 35	-91.8	-91.8 0.12 (1)	10.00	E-H	-1042 / 0	0.52 (1)
L-B	-268 / 0	0.0	0.0 0.03 (1)	7.81			
H-F	-268 / 0	0.0	0.0 0.03 (1)	7.81			
L-K	0 / 782	-18.5	-18.5 0.19 (1)	10.00			
K-J	0 / 557	-18.5	-18.5 0.17 (4)	10.00			
J-I	0 / 557	-18.5	-18.5 0.17 (4)	10.00			
I-H	0 / 782	-18.5	-18.5 0.19 (1)	10.00			

TOTAL WEIGHT = 2 X 72 = 145 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.24/1.00 (B-C:1), BC=0.18/1.00 (H-I:1), WB=0.52/1.00 (C-L:1), SS=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1650


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 6.0 Deg.

JSI GRIP= 0.68 (H) (INPUT = 0.90)
JSI METAL= 0.29 (L) (INPUT = 1.00)

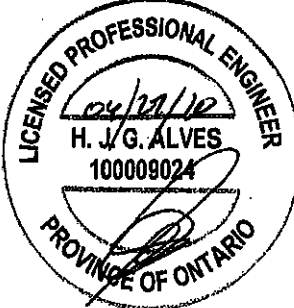


Structural component only
DWG# T-2007156

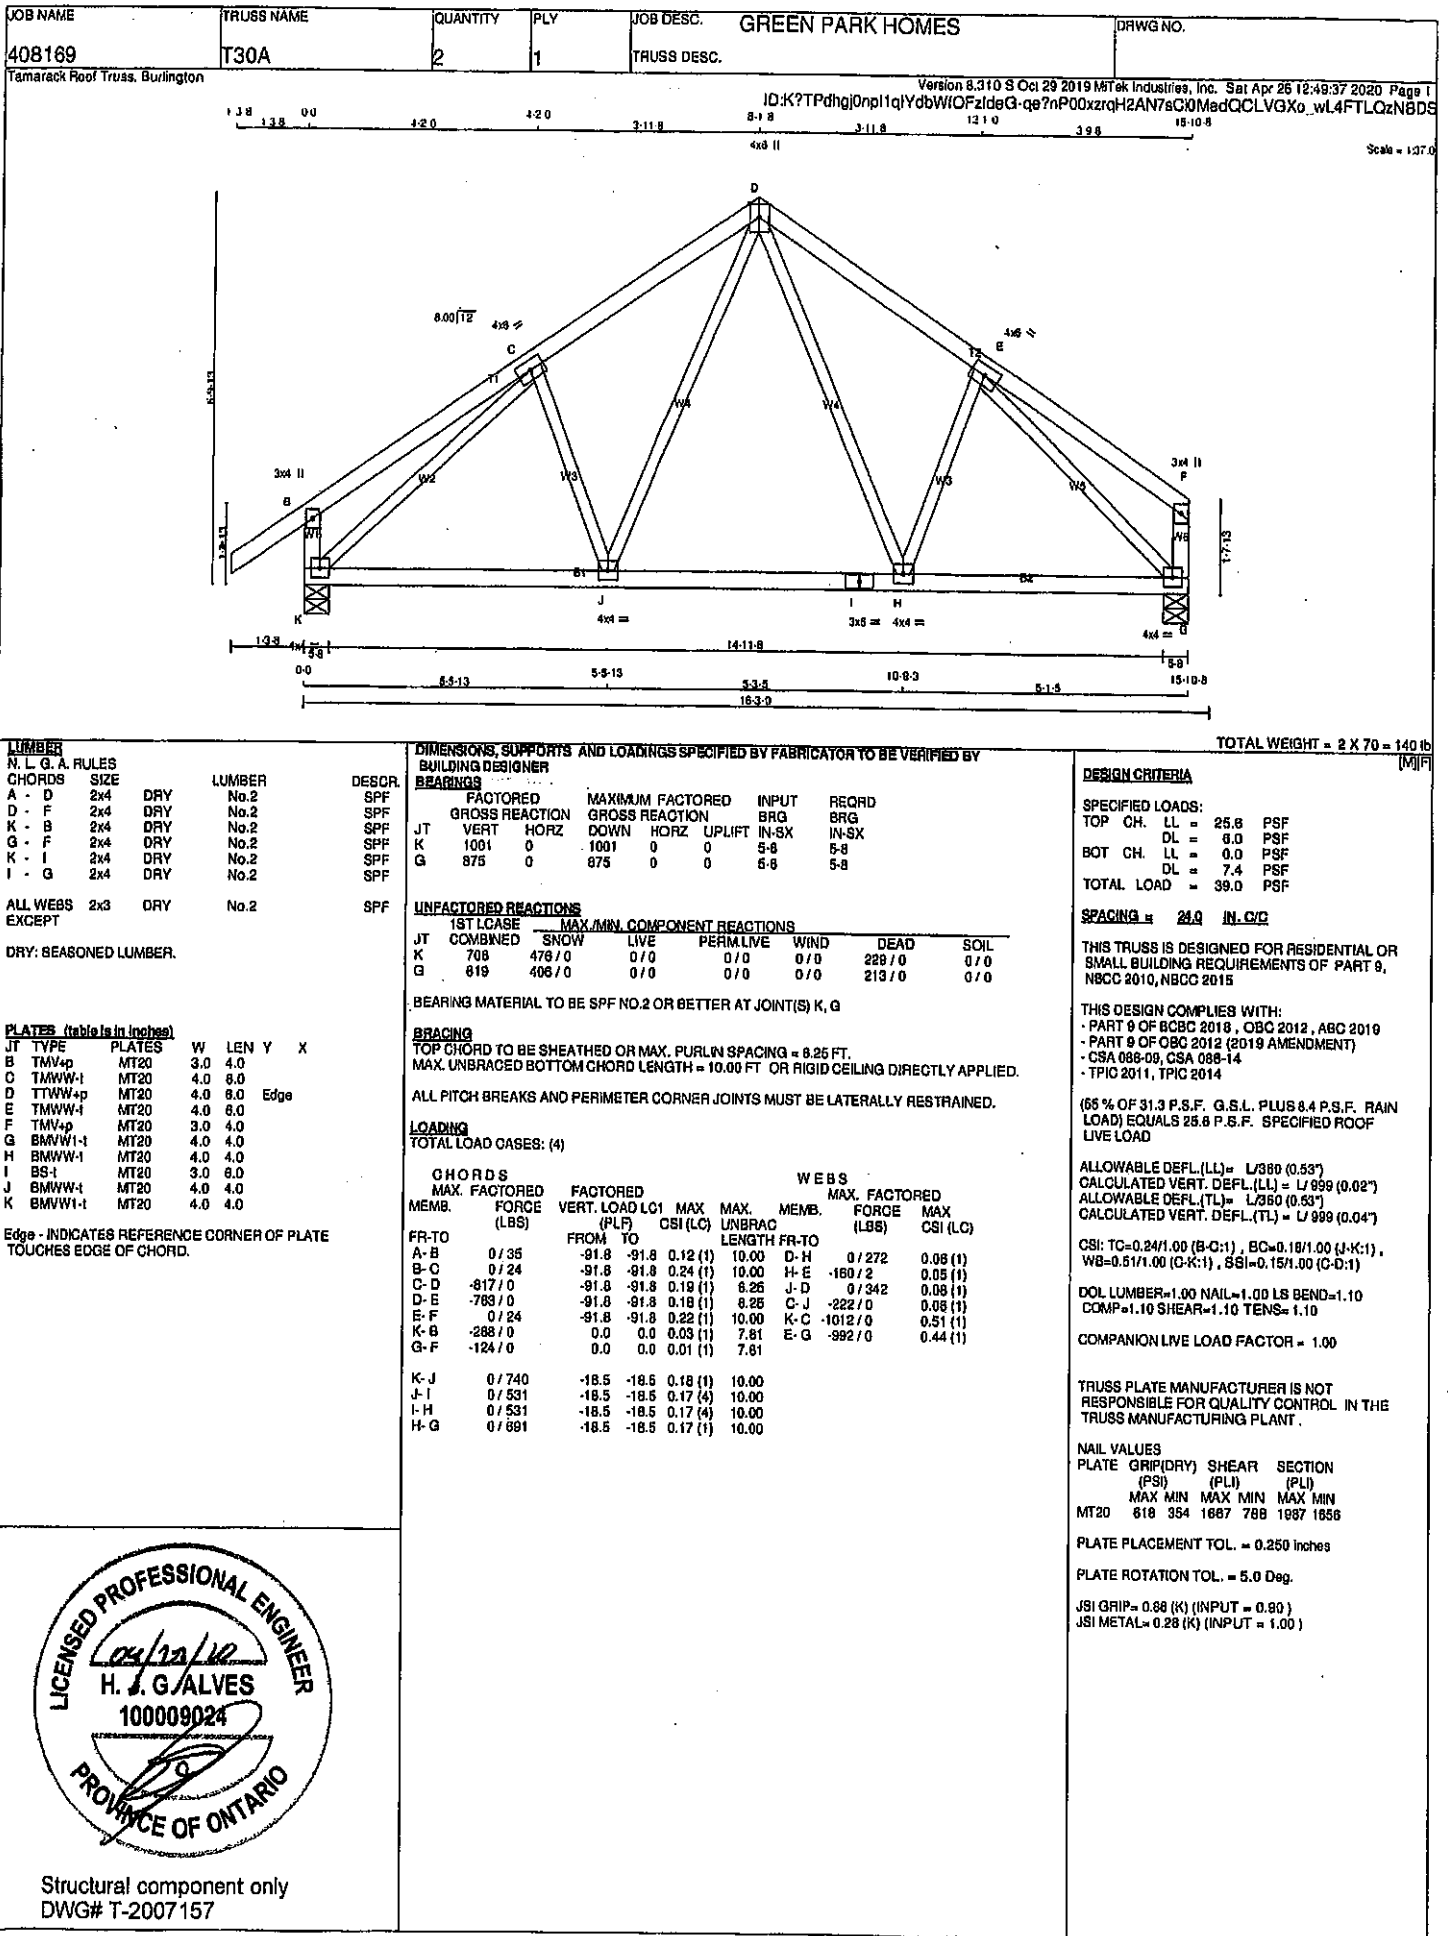

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408169	T30S	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 12:49:36 2020 Page 1
ID:K?TPdghj0npt1qlydbWIOFzideG-lqZ9cm1Zk9y8gKyJQvGFwAbElmYGAw4ak_1uszNBDR

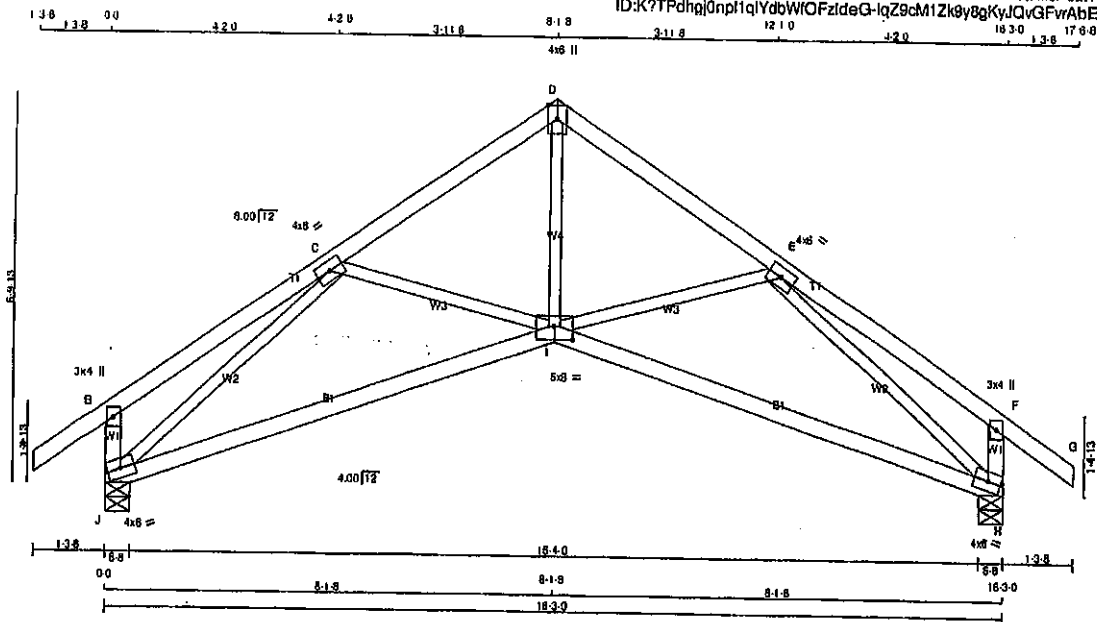

Scale = 1:37.5

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
J - B	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
J - I	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVap	MT20	3.0	4.0		
C	TMWV-I	MT20	4.0	6.0		
D	TTWap	MT20	4.0	6.0	Edge	
E	TMWV-I	MT20	4.0	6.0		
F	TMVap	MT20	3.0	4.0		
H	BMVWV-I	MT20	4.0	6.0		
I	BBVWV-p	MT20	5.0	6.0	2.75	4.00
J	BMVWV-I	MT20	4.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
J	1022	0	1022	0	5-8
H	1022	0	1022	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAXIMUM COMPONENT REACTIONS	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	720	488 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0
H	720	488 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.78 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
A-B	0 / 35	I-D	0 / 942
B-C	0 / 22	I-E	-143 / 11
C-D	-1134 / 0	C-I	-143 / 11
D-E	-1134 / 0	J-C	-1478 / 0
E-F	0 / 22	E-H	-1478 / 0
F-G	0 / 35		
J-B	-273 / 0		
H-F	-273 / 0		
J-I	0 / 1120		
I-H	0 / 1120		

TOTAL WEIGHT = 2 X 97 = 193 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.64")
CALCULATED VERT. DEFL. (LL) = L/899 (0.05")
ALLOWABLE DEFL. (TL) = L/360 (0.64")
CALCULATED VERT. DEFL. (TL) = L/789 (0.25")

CSI: TC=0.22/1.00 (E-F-I), BC=0.44/1.00 (H-I), WB=0.78/1.00 (C-J-I), SS=0.16/1.00 (E-F-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1897 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (H) (INPUT = 0.80)
JSI METAL = 0.35 (H) (INPUT = 1.00)



Structural component only
DWG# T-2007158


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRAWG NO.
408169	T31S	1	1	TRUSS DESC.		

Tamareck Roof Truss, Burlington

ID:K7TPdhgJnpl1qYdbWfOfzIdG-m17Yq18VT47HUXW_dnUR3InH9Cs?pxDpOkaQJzNBDC

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:39 2020 Page 1

Scale = 1:28.8

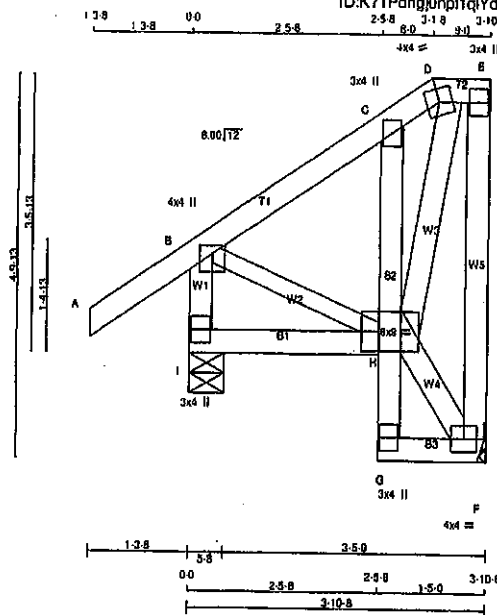

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2			SPF
D - E	2x4	DRY	No.2			SPF
F - E	2x4	DRY	No.2			SPF
I - B	2x4	DRY	No.2			SPF
I - H	2x4	DRY	No.2			SPF
G - C	2x4	DRY	No.2			SPF
G - F	2x4	DRY	No.2			SPF
ALL WEBS	2x4	DRY	No.2			SPF
EXCEPT						
B - H	2x3	DRY	No.2			SPF

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TMV+p	MT20	3.0	4.0		
D	TTW-m	MT20	4.0	4.0		
E	TMV+p	MT20	3.0	4.0		
F	BMVW1-i	MT20	4.0	4.0		
G	BMV+p	MT20	3.0	4.0		
H	BMVWW1-i	MT20	6.0	9.0	3.00	2.75
I	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	DOWN	UPLIFT	IN-SX
F	193	0	0	MECHANICAL
I	381	0	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	COMBINED		88 / 0	0 / 0	0 / 0	49 / 0	0 / 0	0 / 0
I			181 / 0	0 / 0	0 / 0	72 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX	MAX. UNBRACED LENGTH	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX
FR-TO							FR-TO			
A-B	0 / 35	-91.8	-91.8	0.14 (5)	10.00		H-F	-27 / 0	0.00 (1)	
B-C	-87 / 0	-91.8	-91.8	0.09 (1)	6.25		B-H	0 / 88	0.02 (1)	
C-D	-99 / 0	-91.8	-91.8	0.07 (1)	6.25		H-D	0 / 173	0.03 (1)	
D-E	-11 / 0	-91.8	-91.8	0.07 (1)	6.25					
F-E	-148 / 0	0.0	0.0	0.04 (1)	7.81					
I-B	-327 / 0	0.0	0.0	0.02 (4)	7.81					
I-H	0 / 8	-18.5	-18.5	0.03 (4)	10.00					
G-H	-2 / 8	0.0	0.0	0.05 (1)	10.00					
H-C	-203 / 0	0.0	0.0	0.04 (1)	7.81					
G-F	0 / 30	-18.5	-18.5	0.03 (1)	10.00					

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 29 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
80T CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, NBC 2012, ASQ 2019
- PART 9 OF NBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/380 (0.19")
CALCULATED VERT. DEFL. (LL) = L/989 (0.00")
ALLOWABLE DEFL. (TL) = L/380 (0.19")
CALCULATED VERT. DEFL. (TL) = L/989 (0.01")

CSI: TC=0.14/1.00 (A-B:8), BC=0.05/1.00 (G-H:1), WB=0.03/1.00 (D-H:1), SSI=0.12/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PS)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1567 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.23 (B) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)

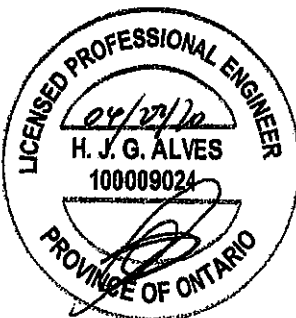

Structural component only
DWG# T-2007159

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T33	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:41 2020 Page 1
ID:K?TPdhgJ0npl1qlydbWfOFzIdeG-iPFIF03S14LjXohu51pyWUo8MznVTaTWGidhUBzNBDC

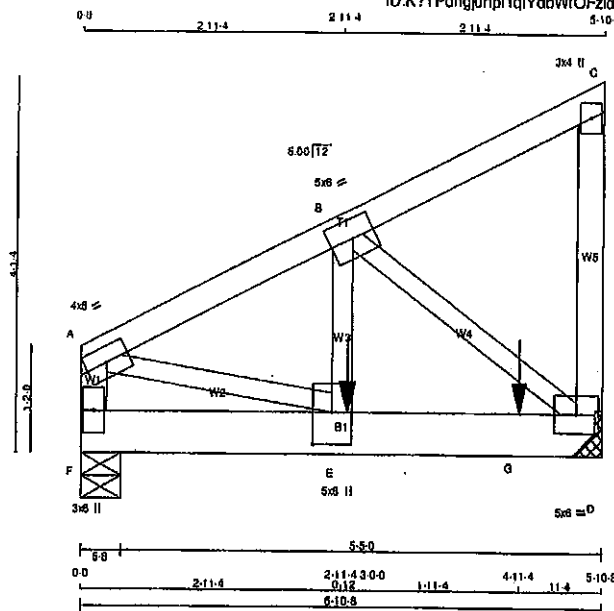

Scale = 1/2" = 1'-0"

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
F - A	2x4	DRY	No.2	SPF		
A - C	2x4	DRY	No.2	SPF		
D - C	2x4	DRY	No.2	SPF		
F - D	2x4	DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F-A 1 12	TOP	
A-C 1 12	TOP	
C-D 1 12	TOP	
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F-D 2 8	SIDE(305.2)	
WEBS : (0.122"x3") SPIRAL NAILS		
B-E 1 2	SIDE(408.9)	
2x3 1 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILO HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
A TMWV-1	MT20	4.0	8.0	Edge		
B TMWV-1	MT20	5.0	6.0			
C TMV-p	MT20	3.0	4.0			
D BMWV-1	MT20	5.0	6.0			
E BMWV-1	MT20	5.0	8.0	4.25	2.50	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UP
F	1814	0	1814	0
D	2859	0	2859	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4'-0".

UNFACTORED REACTIONS

1ST CASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	1348	915/0	0/0	0/0	0/0	434/0	0/0
D	2015	1359/0	0/0	0/0	0/0	857/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.59 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1	MAX. CS1 (LC)	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO							FR-TO			
F-A	-1877 / 0	0.0	0.0	0.10 (1)	7.81	A-E	0 / 2380	0.29 (1)		
A-B	-2668 / 0	-91.8	-91.8	0.08 (1)	5.59	E-B	0 / 2608	0.32 (1)		
B-C	-7 / 0	-91.8	-91.8	0.08 (1)	10.00	B-D	-2898 / 0	0.35 (1)		
D-C	-120 / 0	0.0	0.0	0.01 (1)	7.81					
F-E	0 / 0	-18.5	-18.5	0.01 (1)	10.00					
E-G	0 / 2301	-18.5	-18.5	0.49 (1)	10.00					
G-D	0 / 2301	-18.5	-18.5	0.49 (1)	10.00					

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	3-0-0	-2737	-2737	---	BACK	VERT	TOTAL	---	C1
G	4-11-4	-1388	-1388	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, CBC 2012, ABC 2010
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. 8 SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.10/1.00 (A-F:1), BC=0.49/1.00 (D-E:1),
WB=0.35/1.00 (B-D:1), SS=0.39/1.00 (D-E:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1667 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.84 (B) (INPUT = 0.80)
JSI METAL = 0.44 (E) (INPUT = 1.00)

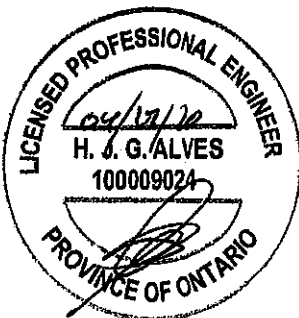

Structural component only
DWG# T-2007161 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T33	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
F	BMV1+p	MT20	3.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.


Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 26 12:49:41 2020 Page 2
ID:K?TPdhq0npl1qYdbWQFzdaG-IPFIFO3S14LIXohu51pyWUo8MznVTaTWGI0hUBzNBDO



Structural component only
DWG# T-2007161 42

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T40	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:15 2020 Page 1
ID:K7TPdHgJ0nPl1qYdbWIOFzIdG-dToLVCBPTKKK_gKpGOLn4U0ubv6N8cfV78ayUzNB1c

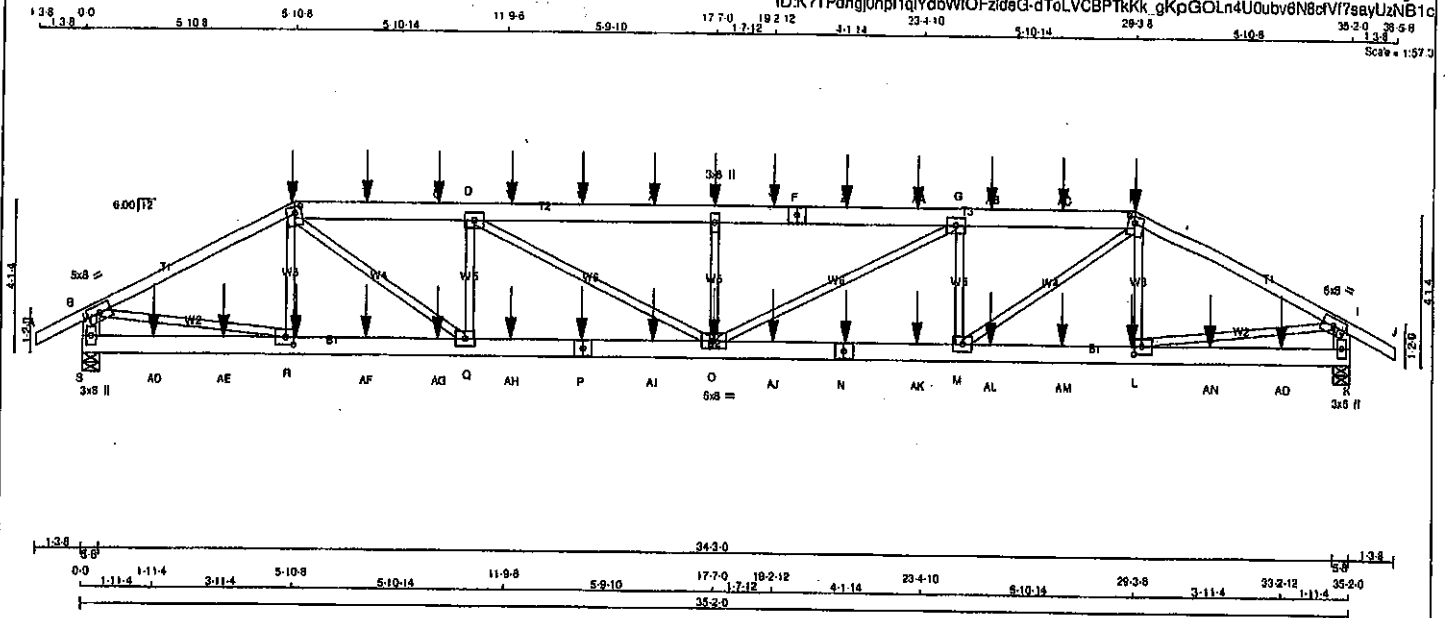

CHORDS	SIZE	DRY	NO.2	DESCR.
A - C	2x4	DRY	No.2	SPF
C - F	2x6	DRY	No.2	SPF
F - H	2x6	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF
S - B	2x6	DRY	No.2	SPF
K - I	2x6	DRY	No.2	SPF
S - P	2x6	DRY	No.2	SPF
P - N	2x6	DRY	No.2	SPF
N - K	2x6	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.
DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-G 1	12	SIDE(81.0)
H-J 1	12	SIDE(81.0)
C-F 2	12	SIDE(81.0)
F-H 2	12	SIDE(81.0)
S-B 2	12	TOP
K-I 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S-P 2	12	SIDE(183.1)
P-N 2	12	SIDE(183.1)
N-K 2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.
TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	DOWN	IN-SX	IN-SX
S	3331 0	3331 0	5-8	5-8
K	3331 0	3331 0	5-8	5-8

UNFACTORED REACTIONS	1ST CASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM LIVE WIND DEAD SOIL
S	2356	1544 / 0 0 / 0 0 / 0 0 / 0 812 / 0 0 / 0
K	2358	1544 / 0 0 / 0 0 / 0 0 / 0 812 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.87 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	UNBRAC LENGTH	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO					FR-TO		
A-B	0 / 28	-91.8 -91.8	0.07 (1)	10.00	R-C	-449 / 0	0.08 (1)
B-C	-5069 / 0	-91.8 -91.8	0.52 (1)	3.87	C-Q	0 / 3021	0.37 (1)
C-T	-8978 / 0	-91.8 -91.8	0.24 (1)	4.35	Q-D	-1808 / 0	0.19 (1)
T-U	-8978 / 0	-91.8 -91.8	0.24 (1)	4.35	D-O	0 / 1339	0.17 (1)
U-D	-8978 / 0	-91.8 -91.8	0.24 (1)	4.35	O-E	-1058 / 0	0.13 (1)
D-V	-9155 / 0	-91.8 -91.8	0.31 (1)	4.02	E-G	0 / 1339	0.17 (1)
V-W	-9155 / 0	-91.8 -91.8	0.31 (1)	4.02	M-G	-1608 / 0	0.19 (1)
W-X	-9155 / 0	-91.8 -91.8	0.31 (1)	4.02	M-H	0 / 3021	0.37 (1)
X-E	-9155 / 0	-91.8 -91.8	0.31 (1)	4.02	L-H	-449 / 0	0.08 (1)
E-Y	-9155 / 0	-91.8 -91.8	0.31 (1)	4.02	B-R	0 / 4585	0.57 (1)
Y-F	-9155 / 0	-91.8 -91.8	0.31 (1)	4.02	L-I	0 / 4585	0.57 (1)
F-Z	-9155 / 0	-91.8 -91.8	0.31 (1)	4.02			
Z-AA	-9155 / 0	-91.8 -91.8	0.31 (1)	4.02			
AA-G	-9155 / 0	-91.8 -91.8	0.31 (1)	4.02			
G-AB	-8978 / 0	-91.8 -91.8	0.24 (1)	4.35			
AB-AC	-8978 / 0	-91.8 -91.8	0.24 (1)	4.35			
AC-H	-8978 / 0	-91.8 -91.8	0.24 (1)	4.35			
H-I	-5069 / 0	-91.8 -91.8	0.52 (1)	3.87			
I-J	0 / 28	-91.8 -91.8	0.07 (1)	10.00			
S-B	-3250 / 0	0.0 0.0	0.11 (1)	7.69			
K-I	-3250 / 0	0.0 0.0	0.11 (1)	7.69			

S-AD	0 / 0	-18.5 -18.5	0.07 (4)	10.00
AD-AE	0 / 0	-18.5 -18.5	0.07 (4)	10.00
AE-R	0 / 0	-18.5 -18.5	0.07 (4)	10.00
R-AF	0 / 4557	-18.5 -18.5	0.33 (1)	10.00
AF-AG	0 / 4557	-18.5 -18.5	0.33 (1)	10.00
AG-Q	0 / 4557	-18.5 -18.5	0.33 (1)	10.00
Q-AH	0 / 6975	-18.5 -18.5	0.52 (1)	10.00
AH-P	0 / 6975	-18.5 -18.5	0.52 (1)	10.00
P-AI	0 / 6975	-18.5 -18.5	0.52 (1)	10.00
AI-O	0 / 6975	-18.5 -18.5	0.52 (1)	10.00
O-AJ	0 / 6975	-18.5 -18.5	0.52 (1)	10.00
AJ-N	0 / 6975	-18.5 -18.5	0.52 (1)	10.00
N-AK	0 / 6975	-18.5 -18.5	0.52 (1)	10.00
AK-M	0 / 6975	-18.5 -18.5	0.52 (1)	10.00
M-AL	0 / 4557	-18.5 -18.5	0.33 (1)	10.00
AL-AM	0 / 4557	-18.5 -18.5	0.33 (1)	10.00
AM-L	0 / 4557	-18.5 -18.5	0.33 (1)	10.00
L-AN	0 / 0	-18.5 -18.5	0.07 (4)	10.00
AN-AO	0 / 0	-18.5 -18.5	0.07 (4)	10.00
AO-K	0 / 0	-18.5 -18.5	0.07 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 8 OF OBC 2012 (2018 AMENDMENT)
- CSA 086-03, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/899 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CS1: TC=0.52/1.00 (B-C:1), BC=0.52/1.00 (O-Q:1), WB=0.57/1.00 (B-R:1), SR=0.16/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1056

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.90 (H) (INPUT = 0.90)
JSI METAL=0.87 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007168 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T40	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 13:02:15 2020 Page 2
ID:K?TPdhnQnpl1qYdbWfQFzldG-dToLVCBPTkKk qKpGOLn4U0ubv6N8cIV78ayUzNB1c

PLATES (tabular in inches)


JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	8.0		
C	TTWW+m	MT20	5.0	8.0	2.00	2.25
D	TMVW-t	MT20	5.0	8.0		
E	TMVW+m	MT20	5.0	8.0		
F	TS-t	MT20	5.0	8.0		
G	TMVW-t	MT20	5.0	8.0		
H	TTWW+m	MT20	5.0	8.0	2.00	2.25
I	TMVW-t	MT20	5.0	8.0		
K	BMV1+p	MT20	3.0	6.0		
L	BMVW-t	MT20	5.0	8.0	2.50	2.50
M	BMVW-t	MT20	5.0	8.0		
N	BS-t	MT20	5.0	8.0		
O	BMVW-t	MT20	5.0	8.0		
P	BS-t	MT20	5.0	8.0		
Q	BMVW-t	MT20	5.0	8.0		
R	BMVW-t	MT20	5.0	8.0	2.50	2.50
S	BMV1+p	MT20	3.0	6.0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-437	-437	---	FRONT	VERT	TOTAL	---	C1
E	17-7-0	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	29-3-8	-437	-437	---	FRONT	VERT	TOTAL	---	C1
L	29-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
N	21-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
O	17-7-0	-28	-28	---	FRONT	VERT	TOTAL	---	C1
P	13-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	19-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	1-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AE	3-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AF	7-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AG	9-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AH	11-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AI	15-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AJ	19-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AK	23-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AL	25-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AM	27-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AN	31-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AO	33-2-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

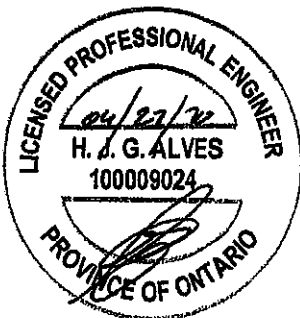

Structural component only
DWG# T-2007168

JOB NAME 408170	TRUSS NAME T40Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:17 2020 Page 1
ID:K7TPdhj0npl1qYdbWIOFzIdG-arw5vuDf_MaSDzUBNpNF9v6BulK?cSGo6JLh0NzNB1a

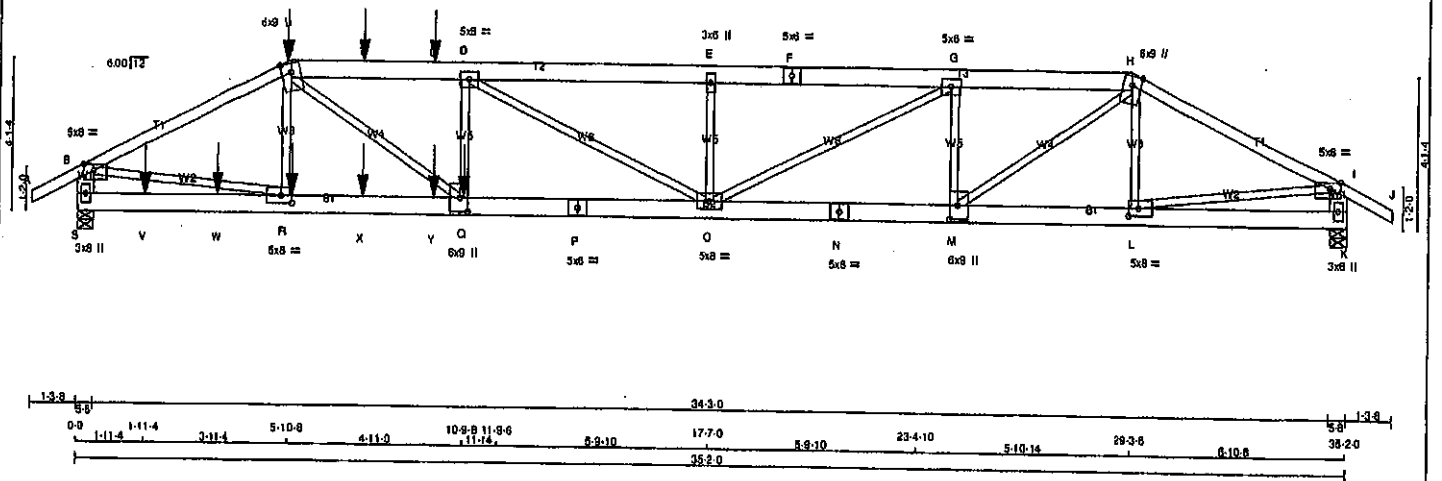

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - F	2x4	DRY	No.2	SPF		
F - H	2x4	DRY	No.2	SPF		
H - J	2x4	DRY	No.2	SPF		
J - L	2x4	DRY	No.2	SPF		
L - M	2x4	DRY	No.2	SPF		
M - N	2x4	DRY	No.2	SPF		
N - K	2x4	DRY	No.2	SPF		
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C 1 12		SIDE(81.0)
H-J 1 12		TOP
C-F 2 12		SIDE(81.0)
F-H 2 12		TOP
S-B 2 12		TOP
K-I 2 12		TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
S-P 2 12		SIDE(183.1)
P-N 2 12		TOP
N-K 2 12		TOP
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1 8		
D-Q 1 3		SIDE(825.1)
G-M 1 3		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	4582	0	0	5-8
S	4582	0	0	5-8
K	3047	0	0	5-8

UNFACTORED REACTIONS

1ST LOABE	MAX/MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
JT COMBINED				
S	3236 2151 / 0	0 / 0	0 / 0	1084 / 0
K	2151 1438 / 0	0 / 0	0 / 0	715 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.15 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO			FR-TO	
A-B	0 / 28	-91.8 -91.8 0.07 (1)	R-C	-673 / 0
B-C	-7203 / 0	-91.8 -91.8 0.72 (1)	C-D	0 / 4988
C-T	-10548 / 0	-91.8 -91.8 0.34 (1)	D-O	-184 / 28
T-U	-10548 / 0	-91.8 -91.8 0.34 (1)	O-G	-1207 / 0
U-D	-10548 / 0	-91.8 -91.8 0.34 (1)	G-E	-648 / 0
D-E	-8485 / 0	-91.8 -91.8 0.31 (1)	E-G	0 / 2871
E-F	-8485 / 0	-91.8 -91.8 0.29 (1)	M-H	-1984 / 0
F-G	-8485 / 0	-91.8 -91.8 0.29 (1)	H-H	0 / 3512
G-H	-8958 / 0	-91.8 -91.8 0.17 (1)	L-H	-464 / 0
H-I	-4808 / 0	-91.8 -91.8 0.48 (1)	B-R	0 / 6588
I-J	0 / 28	-91.8 -91.8 0.07 (1)	L-I	0 / 4187
S-B	-4503 / 0	0.0 0.0 0.16 (1)		
K-I	-2990 / 0	0.0 0.0 0.11 (1)		

S-V	0 / 0	-18.5 -18.5 0.08 (4)	10.00
V-W	0 / 0	-18.5 -18.5 0.08 (4)	10.00
W-R	0 / 0	-18.5 -18.5 0.08 (4)	10.00
R-X	0 / 8587	-18.5 -18.5 0.50 (1)	10.00
X-Y	0 / 8587	-18.5 -18.5 0.50 (1)	10.00
Y-Q	0 / 8587	-18.5 -18.5 0.50 (1)	10.00
Q-P	0 / 10548	-18.5 -18.5 0.77 (1)	10.00
P-O	0 / 10548	-18.5 -18.5 0.77 (1)	10.00
O-N	0 / 8955	-18.5 -18.5 0.50 (1)	10.00
N-M	0 / 8955	-18.5 -18.5 0.50 (1)	10.00
M-L	0 / 4144	-18.5 -18.5 0.29 (1)	10.00
L-K	0 / 0	-18.5 -18.5 0.04 (4)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-437	-437	---	BACK	VERT	TOTAL	---	C1
Q	10-9-8	-2715	-2715	---	BACK	VERT	TOTAL	---	C1
R	5-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
U	7-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	9-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	1-11-4	-25	-25	---	BACK	VERT	TOTAL	---	C1
X	3-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
Y	7-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
	9-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
BOT CH. LL = 6.0 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TRG 2011, TRG 2014

(55 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.28")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/881 (0.48")

CSI: TC=0.72/1.00 (B-C:1), BC=0.77/1.00 (C-Q:1),
WB=0.82/1.00 (B-R:1), SS=0.13/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.80 (S) (INPUT = 0.90)
JSI METAL = 0.99 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007169

CONTINUED ON PAGE 2

JOB NAME 408170	TRUSS NAME T40Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Remareck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 13:02:17 2020 Page 2
ID:K?TPdhlQnpl1qYdbWlOPzIdeG-arw5vuDf MaSDzUBNpNF9v6Buik?cSGo8JLh0NzNB1a


PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	2.00	3.50
C TTWW+m	MT20	6.0	9.0	Edge	
D TMWW-l	MT20	5.0	6.0		
E TMW+w	MT20	3.0	6.0		
F TS-l	MT20	5.0	6.0		
G TMWW-l	MT20	5.0	6.0		
H TTWW+m	MT20	6.0	9.0	Edge	
I TMVW-p	MT20	5.0	6.0	2.00	3.50
K BMVl+p	MT20	3.0	6.0		
L BMWW-l	MT20	5.0	6.0	2.50	3.25
M BMWW+l	MT20	6.0	9.0	4.50	2.50
N BS-l	MT20	5.0	6.0		
O BMWWW-l	MT20	5.0	6.0		
P BS-l	MT20	5.0	6.0		
Q BMWW+l	MT20	6.0	9.0	4.50	2.50
R BMWW-l	MT20	5.0	6.0	2.50	3.25
S - BMVl+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

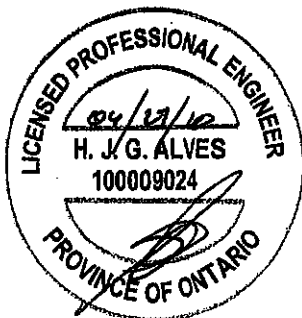

Structural component only
DWG# T-2007169


100008024
PROVINCE OF ONTARIO
Structural component only
DWG# T-2007170

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408170	T43	2	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:20 2020 Page 1

ID:K?TPdhgJ0npl1qYobWfOfzIdaG- CcEYwFYHHz04Rcm3xxynXkIMwqOpsVEoHZLdzNB1X

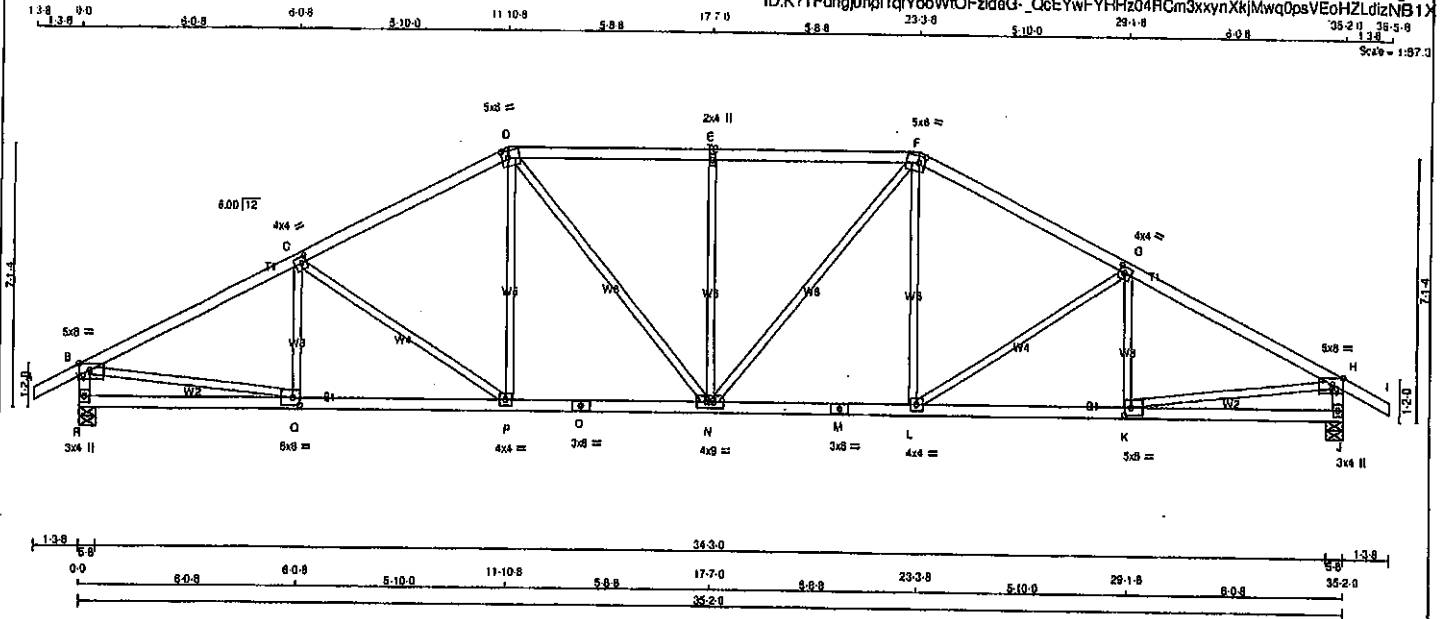

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. ALL WEBS 2x3 DRY No.2 EXCEPT DRY: SEASONED LUMBER.

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - I	2x4	DRY No.2	SPF
R - B	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
R - O	2x4	DRY No.2	SPF
O - M	2x4	DRY No.2	SPF
M - J	2x4	DRY No.2	SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
	FACTORED	MAXIMUM FACTORED	INPUT	REQD			
	GROSS REACTION	GROSS REACTION	BRG	BRG			
JT	VERT.	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
R	2083	0	2083	0	0	5-8	5-8
J	2083	0	2083	0	0	5-8	5-8

UNFACTORED REACTIONS 1ST LCASE MAX/MIN COMPONENT REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1457	959 / 0	0 / 0	0 / 0	0 / 0	489 / 0	0 / 0
J	1457	959 / 0	0 / 0	0 / 0	0 / 0	489 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	MAX	MEMB.	MAX. FACTORED	FACTORED	MAX
	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (CS1 (LO))		FORCE (LBS)	MAX. FACTORED	CS1 (LO)
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 28	-91.8 -91.8	0.12 (1)	10.00	Q-C	-255 / 12	0.07 (1)
B-C	-2889 / 0	-91.8 -91.8	0.58 (1)	3.88	C-P	-435 / 0	0.42 (1)
C-D	-2839 / 0	-91.8 -91.8	0.52 (1)	3.83	P-D	0 / 350	0.08 (1)
D-E	-2559 / 0	-91.8 -91.8	0.48 (1)	3.85	D-N	0 / 482	0.11 (1)
E-F	-2559 / 0	-91.8 -91.8	0.48 (1)	3.85	N-E	-841 / 0	0.58 (1)
F-G	-2559 / 0	-91.8 -91.8	0.82 (1)	3.83	N-F	0 / 482	0.11 (1)
G-H	-2889 / 0	-91.8 -91.8	0.58 (1)	3.88	L-F	0 / 350	0.08 (1)
H-I	0 / 28	-91.8 -91.8	0.12 (1)	10.00	L-G	-435 / 0	0.42 (1)
R-B	-2014 / 0	0.0 0.0	0.20 (1)	5.95	K-G	-255 / 12	0.07 (1)
J-H	-2014 / 0	0.0 0.0	0.20 (1)	5.95	B-Q	0 / 2835	0.59 (1)
R-Q	0 / 0	-18.5 -18.5	0.15 (4)	10.00	K-H	0 / 2835	0.59 (1)
Q-P	0 / 2809	-18.5 -18.5	0.49 (1)	10.00			
P-O	0 / 2249	-18.5 -18.5	0.43 (1)	10.00			
O-N	0 / 2249	-18.5 -18.5	0.43 (1)	10.00			
N-M	0 / 2249	-18.5 -18.5	0.43 (1)	10.00			
M-L	0 / 2249	-18.5 -18.5	0.43 (1)	10.00			
L-K	0 / 2609	-18.5 -18.5	0.49 (1)	10.00			
K-J	0 / 0	-18.5 -18.5	0.15 (4)	10.00			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2010, NBCO 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBCO 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TRUD 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSI: TC=0.58/1.00 (B-C:1), BC=0.49/1.00 (P-Q:1), WB=0.59/1.00 (B-Q:1), SSI=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1858

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP=0.88 (Q) (INPUT = 0.90)
JSI METAL=0.88 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007172

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T44	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 26 13:02:21 2020 Page 1
ID:K?TPdhqj0npl1qVdbWIOFzIdG-SdAciGGA2a5tbnycf9BKIGrDK9jYJhN1xJv98zNB1W

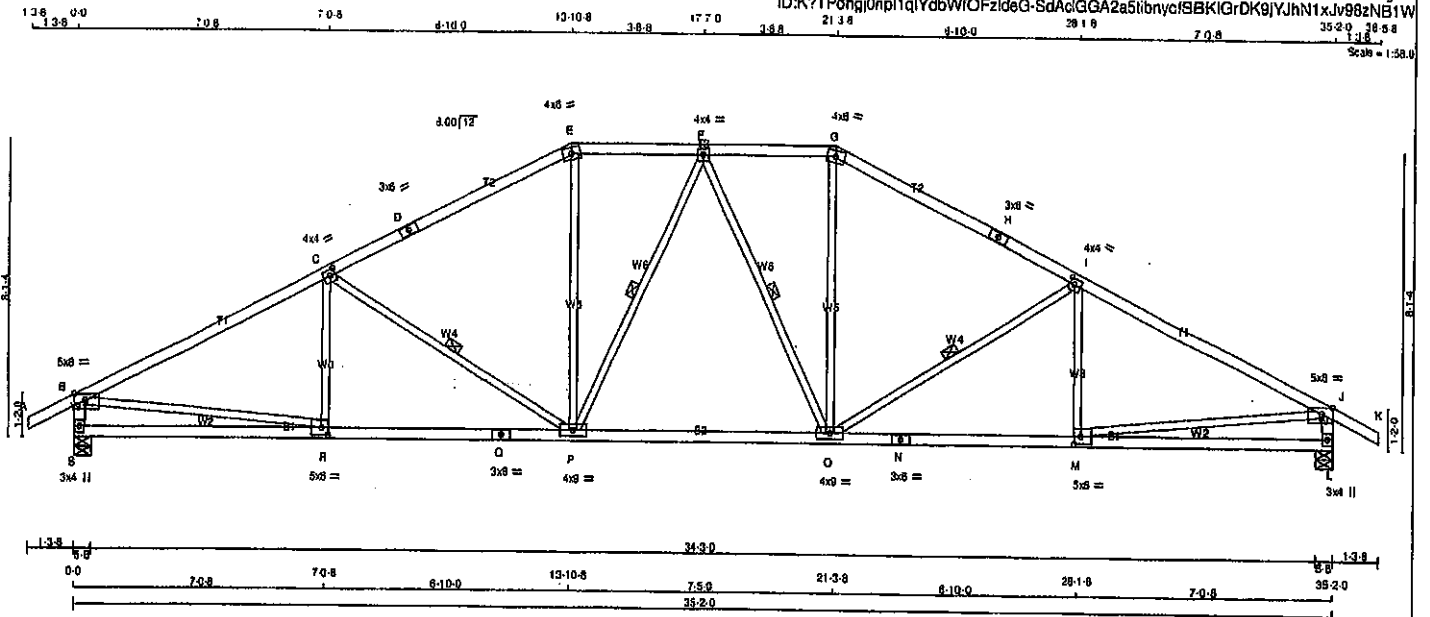

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TMVW-t	MT20	4.0	4.0	2.00	1.75
D	TS-t	MT20	3.0	6.0		
E	TTW-m	MT20	4.0	8.0		
F	TMVW-t	MT20	4.0	4.0		
G	TTW-m	MT20	4.0	8.0		
H	TS-t	MT20	3.0	6.0		
I	TMVW-t	MT20	4.0	4.0	2.00	1.75
J	TMVW-p	MT20	5.0	8.0	Edge	3.50
L	BMV1-p	MT20	3.0	4.0		
M	BMVW-t	MT20	5.0	8.0	2.50	2.25
N	BS-t	MT20	3.0	6.0		
O	BMVW-t	MT20	4.0	8.0		
P	BMVW-t	MT20	4.0	8.0		
Q	BS-t	MT20	3.0	6.0		
R	BMVW-t	MT20	5.0	8.0	2.50	2.25
S	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
S	2083	0	2083	0	5-8
L	2083	0	2083	0	5-8

UNFACTORED REACTIONS

1ST CASE		MAX/MIN COMPONENT REACTIONS			
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
S	1457	889 / 0	0 / 0	0 / 0	488 / 0
L	1457	889 / 0	0 / 0	0 / 0	488 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-P, F-P, F-O, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	R-C	-182 / 52	0.06 (1)
B-C	-2808 / 0	-91.8	-91.8 0.83 (1)	3.25	C-P	-637 / 0	0.29 (1)
C-D	-2373 / 0	-91.8	-91.8 0.72 (1)	3.66	P-E	0 / 674	0.15 (1)
D-E	-2373 / 0	-91.8	-91.8 0.72 (1)	3.66	F-F	-222 / 0	0.11 (1)
E-F	-2100 / 0	-91.8	-91.8 0.19 (1)	4.63	F-O	-222 / 0	0.11 (1)
F-G	-2100 / 0	-91.8	-91.8 0.19 (1)	4.63	O-G	0 / 674	0.15 (1)
G-H	-2373 / 0	-91.8	-91.8 0.72 (1)	3.66	C-I	-637 / 0	0.29 (1)
H-I	-2373 / 0	-91.8	-91.8 0.72 (1)	3.66	M-I	-182 / 52	0.06 (1)
I-J	-2908 / 0	-91.8	-91.8 0.83 (1)	3.25	B-R	0 / 2849	0.60 (1)
J-K	0 / 28	-91.8	-91.8 0.12 (1)	10.00	M-J	0 / 2849	0.60 (1)
S-B	-2008 / 0	0.0	0.0 0.20 (1)	5.98			
L-J	-2008 / 0	0.0	0.0 0.20 (1)	5.98			
S-R	0 / 0	-18.5	-18.5 0.20 (4)	10.00			
R-Q	0 / 2830	-18.5	-18.5 0.52 (1)	10.00			
Q-P	0 / 2830	-18.5	-18.5 0.52 (1)	10.00			
P-O	0 / 2193	-18.5	-18.5 0.45 (1)	10.00			
O-N	0 / 2830	-18.5	-18.5 0.52 (1)	10.00			
N-M	0 / 2830	-18.5	-18.5 0.52 (1)	10.00			
M-L	0 / 0	-18.5	-18.5 0.20 (4)	10.00			

TOTAL WEIGHT = 2 X 145 = 291 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(85 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.14")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.30")

CSI: TO=0.83/1.00 (B-C:1), BO=0.52/1.00 (P-R:1), WB=0.60/1.00 (B-R:1), SSI=0.28/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLJ) (PLJ)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1697 788 1987 1658


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.88 (M) (INPUT = 0.90)
JSI METAL = 0.79 (Q) (INPUT = 1.00)

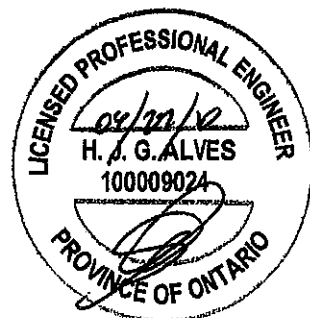


Structural component only
DWG# T-2007173

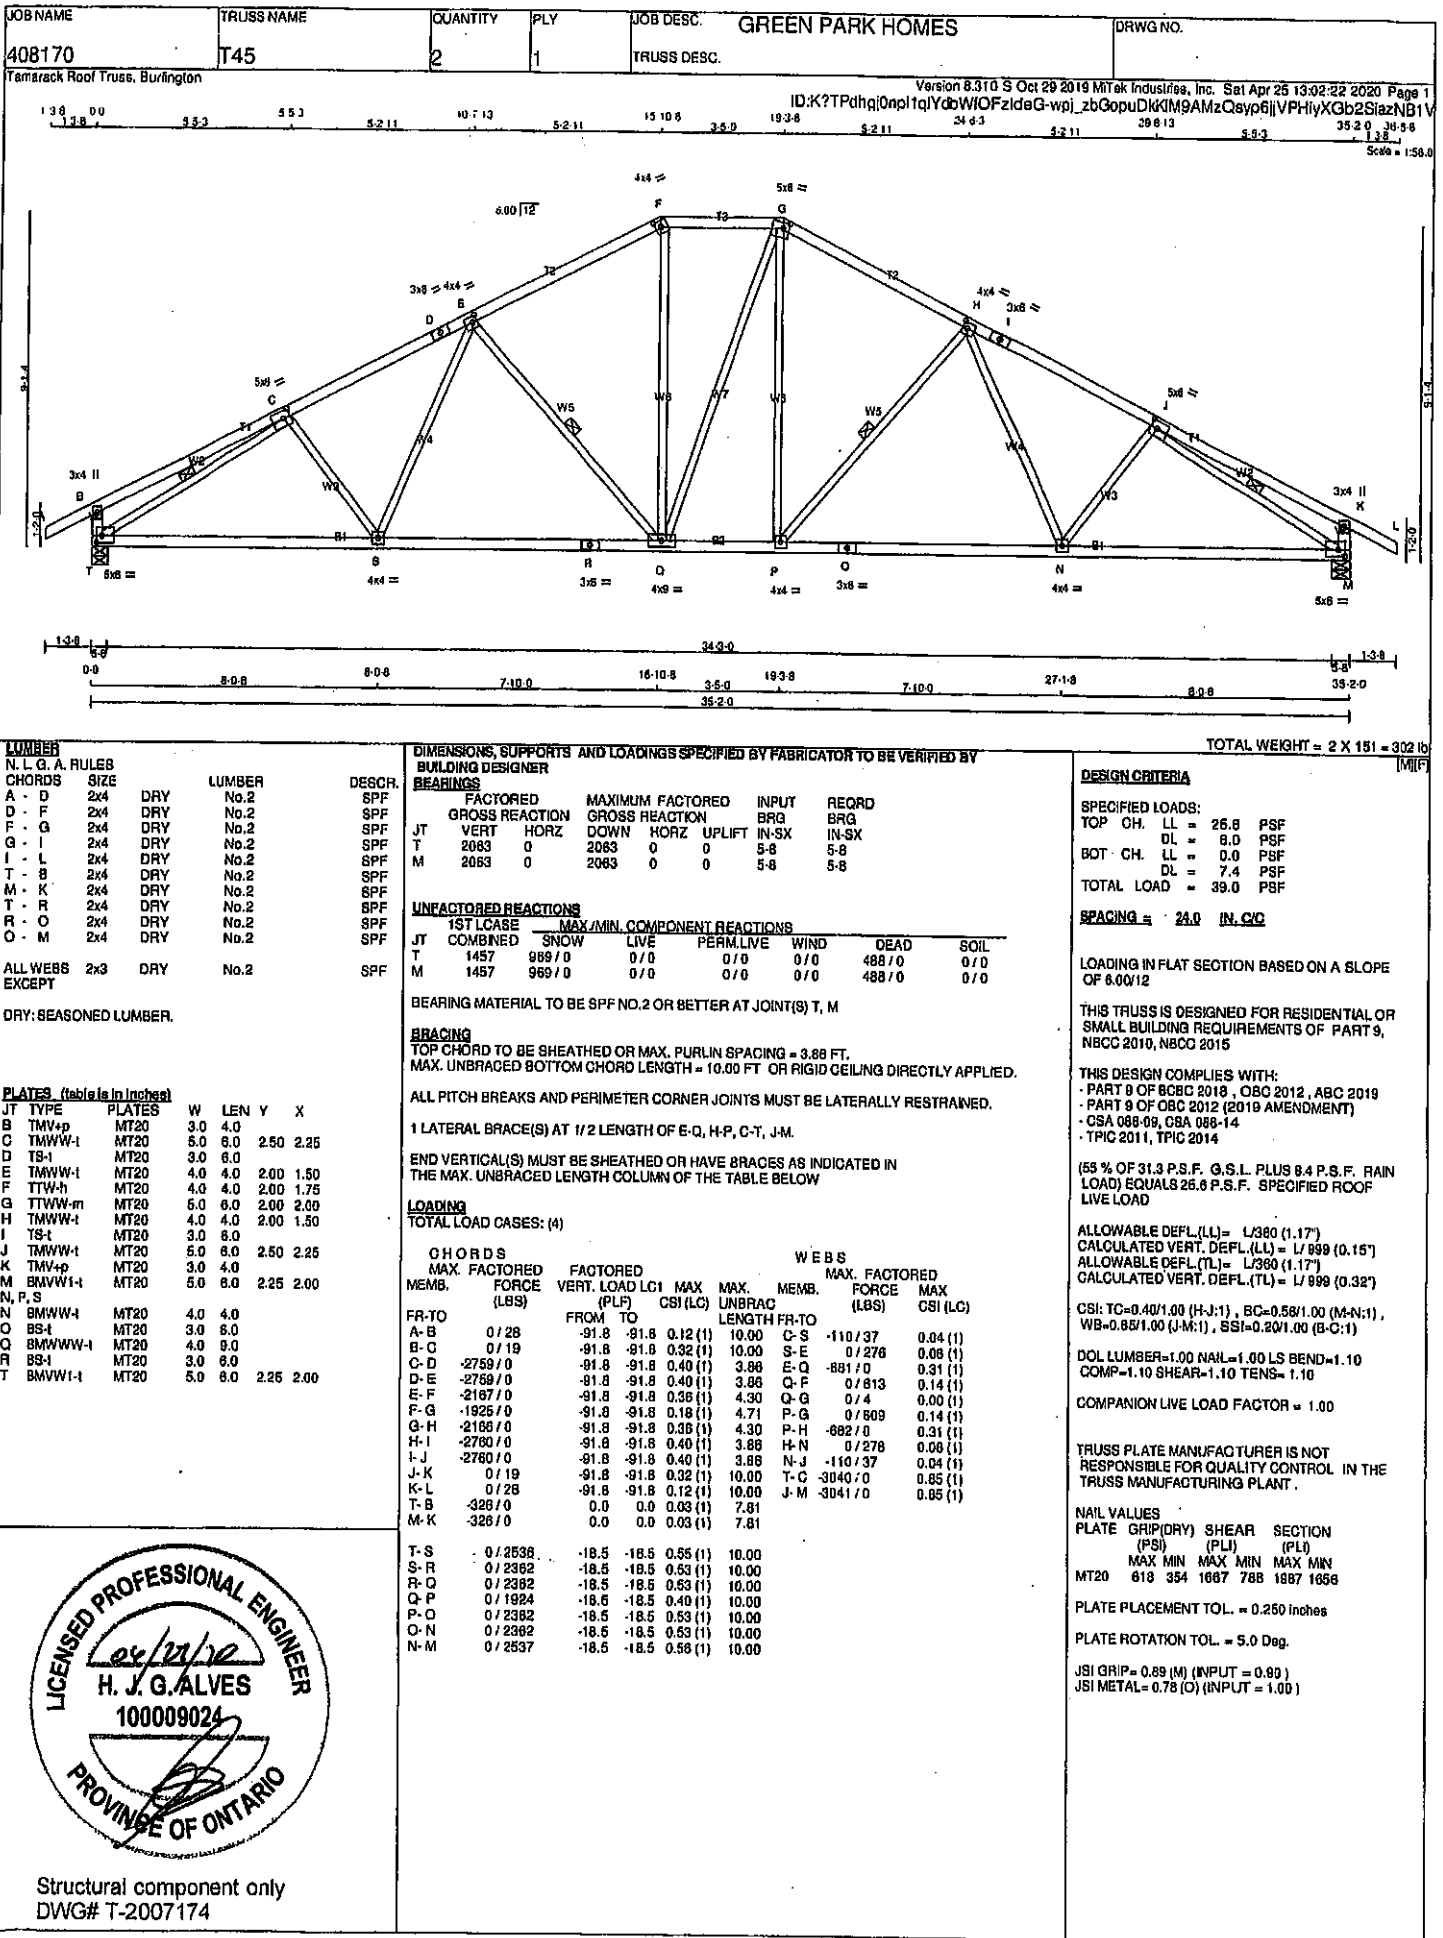

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T46	6	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 13:02:23 2020 Page 1
ID:K7TPdHgJ0npl1qYdbWIOFzIdeG-O7HMAxHQaCLbxuXk4UlpALGz7q50ADgUf07E1zNB1U

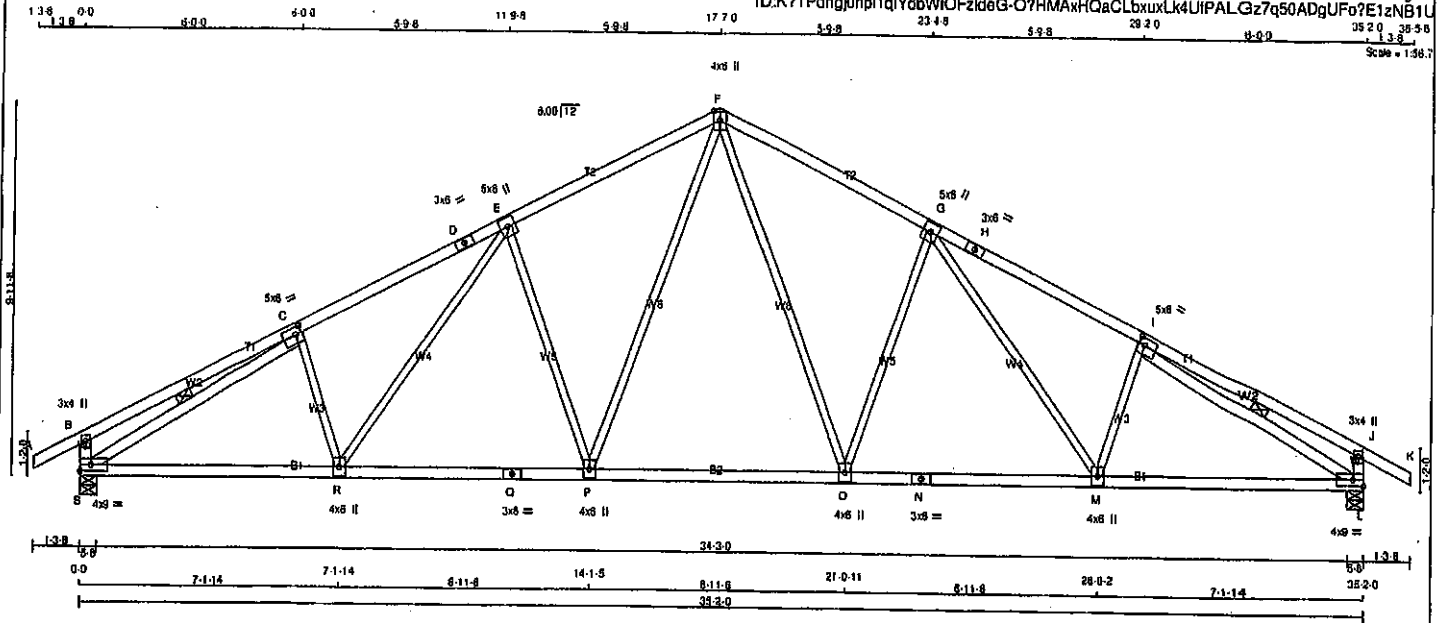

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMWW-t	MT20	5.0	8.0	2.25 2.00
D	TS-t	MT20	3.0	8.0	
E	TMWW-t	MT20	5.0	8.0	
F	TTWW+p	MT20	4.0	8.0	Edge
G	TMWW-t	MT20	5.0	8.0	
H	TS-t	MT20	3.0	8.0	
I	TMWW-t	MT20	5.0	8.0	2.25 2.00
J	TMV+p	MT20	3.0	4.0	
L	BMVW-t	MT20	4.0	9.0	Edge
M	BMVW-t	MT20	4.0	8.0	
N	BS-t	MT20	3.0	8.0	
Q	BS-t	MT20	3.0	8.0	
S	BMVW-t	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS	REACTION	DOWN	HOZ	IN-SX	BRG	IN-SX	BRG
S	2063	0	2063	0	0	5-8	5-8	5-8	5-8
L	2063	0	2063	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX/MIN COMPONENT REACTIONS		LIVE		PERM LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW
S	1457	989 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0
L	1457	989 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, I-L

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MAX. MEMB.	FORCE (LBS)	MAX. MEMB.	FORCE (LBS)
FR-TO		FROM	TO	UNBRACED	FR-TO	FROM	TO
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	F-O	0 / 888	0.19 (1)
B-C	0 / 22	-91.8	-91.8 0.40 (1)	10.00	O-G	-728 / 0	0.72 (1)
C-D	-2808 / 0	-91.8	-91.8 0.49 (1)	3.75	G-M	0 / 391	0.09 (1)
D-E	-2808 / 0	-91.8	-91.8 0.49 (1)	3.75	M-I	-192 / 18	0.05 (1)
E-F	-2322 / 0	-91.8	-91.8 0.48 (1)	4.07	P-F	0 / 888	0.19 (1)
F-G	-2322 / 0	-91.8	-91.8 0.48 (1)	4.07	E-P	-728 / 0	0.72 (1)
G-H	-2808 / 0	-91.8	-91.8 0.49 (1)	3.75	R-E	0 / 391	0.09 (1)
H-I	-2808 / 0	-91.8	-91.8 0.49 (1)	3.75	C-R	-192 / 18	0.05 (1)
I-J	0 / 22	-91.8	-91.8 0.40 (1)	10.00	S-C	-3084 / 0	0.72 (1)
J-K	0 / 28	-91.8	-91.8 0.12 (1)	10.00	I-L	-3084 / 0	0.72 (1)
S-B	-344 / 0	0.0	0.0 0.03 (1)	7.81			
L-J	-344 / 0	0.0	0.0 0.03 (1)	7.81			
S-R	0 / 2574	-18.5	-18.5 0.53 (1)	10.00			
R-Q	0 / 2291	-18.5	-18.5 0.47 (1)	10.00			
Q-P	0 / 2291	-18.5	-18.5 0.47 (1)	10.00			
P-O	0 / 1762	-18.5	-18.5 0.39 (1)	10.00			
O-N	0 / 2291	-18.5	-18.5 0.47 (1)	10.00			
N-M	0 / 2291	-18.5	-18.5 0.47 (1)	10.00			
M-L	0 / 2574	-18.5	-18.5 0.53 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.14')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.28')

CSI: TC=0.48/1.00 (G-H), BC=0.53/1.00 (H-S), WB=0.72/1.00 (E-P), SSI=0.22/1.00 (B-C-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1658


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (C) (INPUT = 0.90)
JSI METAL = 0.77 (I) (INPUT = 1.00)



Structural component only
DWG# T-2007175

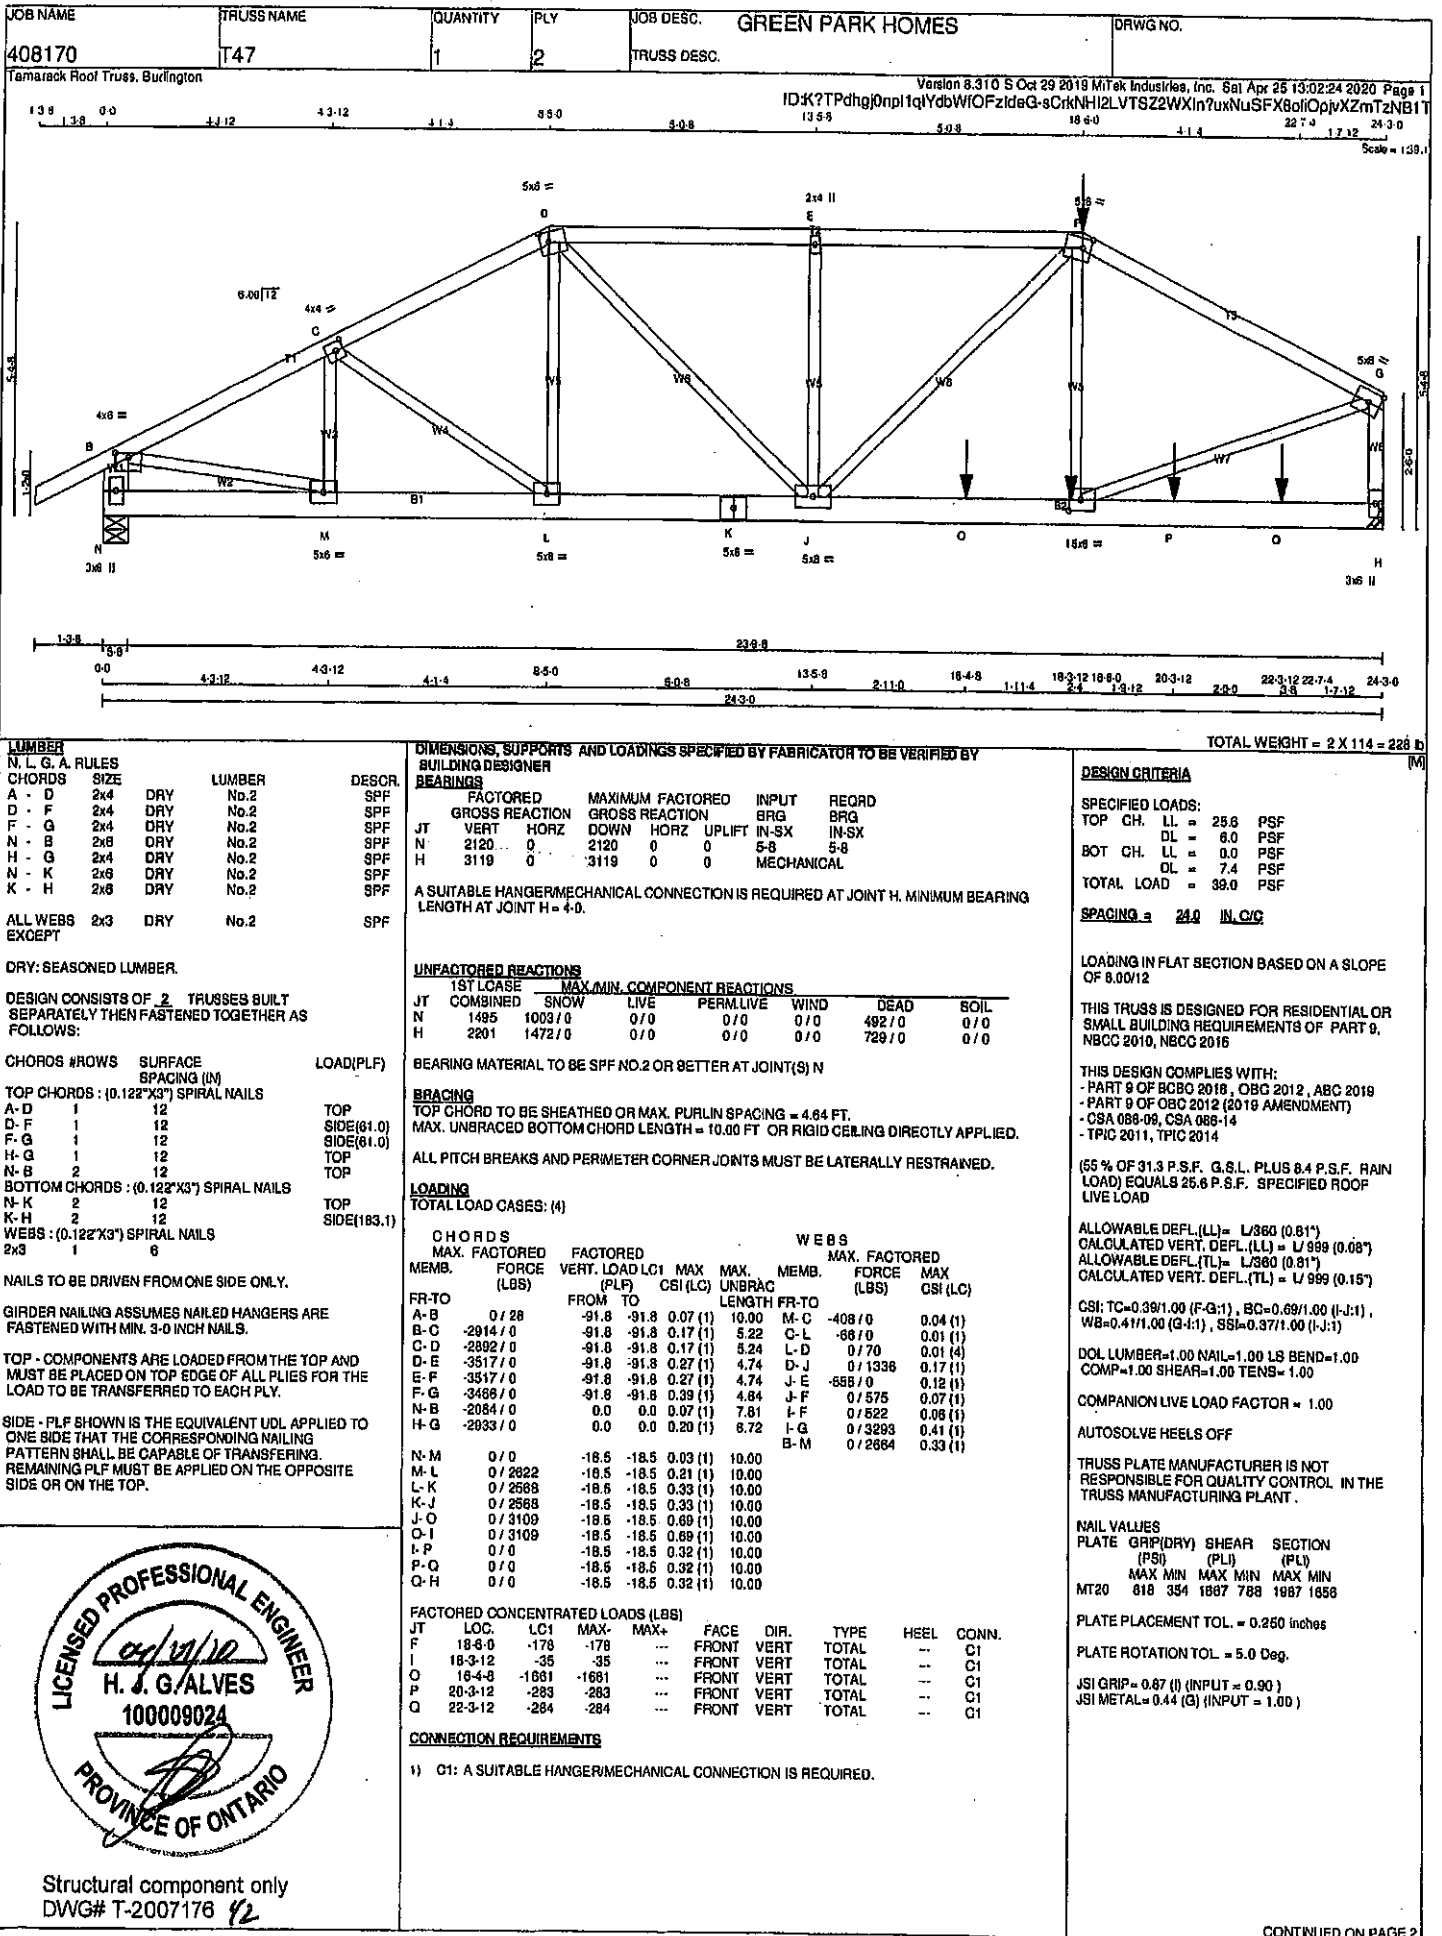

JOB NAME 408170	TRUSS NAME T47	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 13:02:24 2020 Page 2
ID:K?TPdHgQnpl1qYdbWIOFzIdaG-sCkNHl2LVTSZ2WXIn?uxNuSFX8ofOpivXZmTzNB1T

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	6.0	1.00	3.00
C	TMWW-l	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	6.0	2.25	2.00
E	TMW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.25	2.00
G	TMVW-l	MT20	5.0	6.0		Edge
H	BMV1-p	MT20	3.0	6.0		
I	BMWW-l	MT20	5.0	6.0	2.50	2.75
J	BMWWW-l	MT20	5.0	6.0		
K	BS-l	MT20	5.0	6.0		
L	BMWW-l	MT20	5.0	6.0		
M	BMWW-l	MT20	5.0	6.0		
N	BMV1-p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2007176 *1/2*

JOB NAME 408170	TRUSS NAME T48	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MITEX Industries, Inc. Sat Apr 25 13:02:26 2020 Page 1	

ID:K?TPdhg0np1q1YcbWIOFzideG-L0P7bdJg8pbJBC5KrUX7UbRcdXZ9U3GzyZH6ivzNB1S

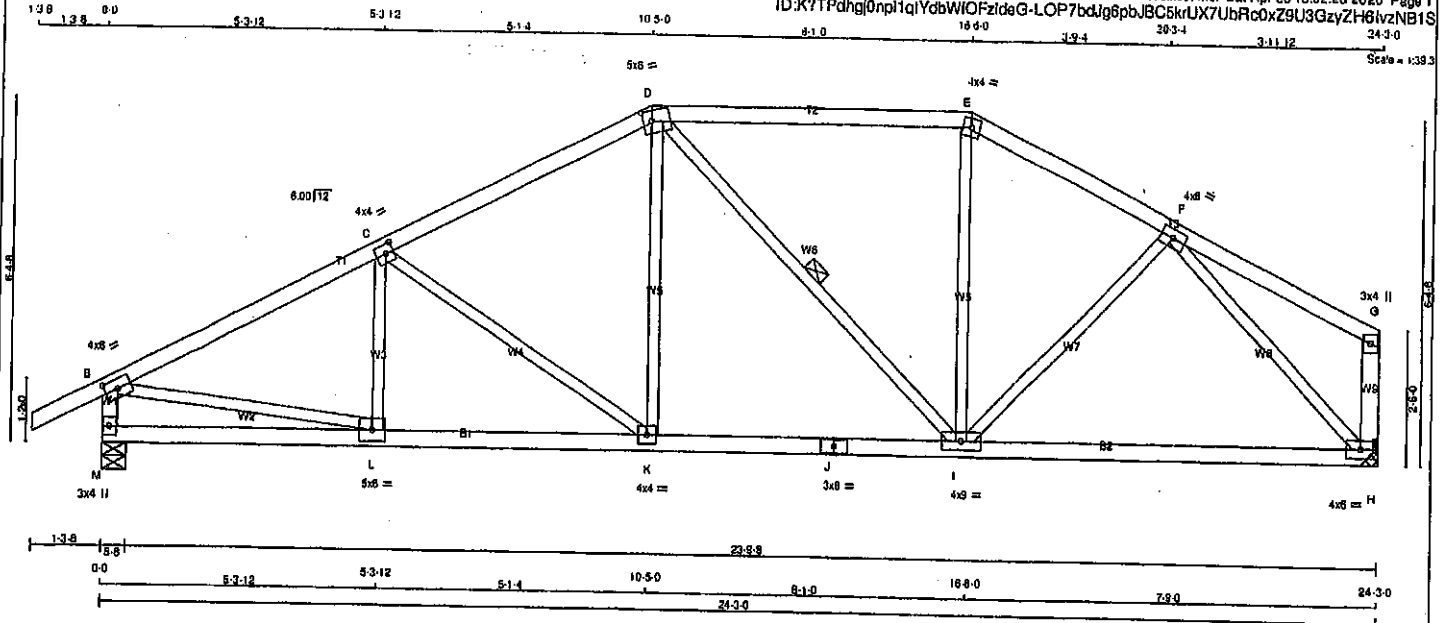

LUMBER				
N. L. & A. RULES				
CHORDS		SIZE		LUMBER
A - D	2x4	DRY		No.2
D - E	2x4	DRY		No.2
E - G	2x4	DRY		No.2
M - B	2x4	DRY		No.2
H - G	2x4	DRY		No.2
M - J	2x4	DRY		No.2
J - H	2x4	DRY		No.2
ALL WEBS EXCEPT	2x3	DRY		No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)							
JT	TYPE	PLATES	W	LEN	Y	X	
B	TMWV-4	MT20	4.0	8.0	2.00	3.00	
C	TMWV-4	MT20	4.0	4.0	2.00	1.75	
D	TTWV-m	MT20	5.0	8.0	2.25	2.00	
E	TTW-m	MT20	4.0	4.0			
F	TMWV-4	MT20	4.0	8.0			
G	TMV+p	MT20	3.0	4.0			
H	BMWV-1-t	MT20	4.0	8.0			
I	BMWVWV-1	MT20	4.0	8.0			
J	BS-4	MT20	3.0	8.0			
K	BMWV-4	MT20	4.0	4.0			
L	BMWV-4	MT20	5.0	8.0			
M	BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	1481	0	5-8
M VERT	1481	0	5-8
H VERT	1337	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	PERM. WIND	DEAD	SOIL
JT COMBINED	1031	880 / 0	0 / 0	0 / 0	341 / 0
M	945	820 / 0	0 / 0	0 / 0	325 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-L

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 (PLF)	MEMB.	FORCE (LBS)
PR-TO			FR-TO	
A-B	0 / 28	-91.8	L-C	-165 / 32
B-C	-1844 / 0	-91.8	C-K	-438 / 0
C-D	-1488 / 0	-91.8	K-D	0 / 334
D-E	-1181 / 0	-91.8	D-I	-189 / 0
E-F	-1338 / 0	-91.8	I-E	0 / 175
F-G	0 / 18	-91.8	I-F	0 / 158
M-B	-1419 / 0	0.0	B-L	0 / 1692
H-G	-138 / 0	0.0	F-H	-1683 / 0
M-L	0 / 0	-18.5		
L-K	0 / 1871	-18.5		
K-J	0 / 1313	-18.5		
J-I	0 / 1313	-18.5		
I-H	0 / 1089	-18.5		

TOTAL WEIGHT = 89 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.81")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.48/1.00 (D-E:1), BC=0.38/1.00 (I-K:4), WB=0.82/1.00 (F-H:1), SSI=0.22/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 788 1887 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.50 (B) (INPUT = 1.00)

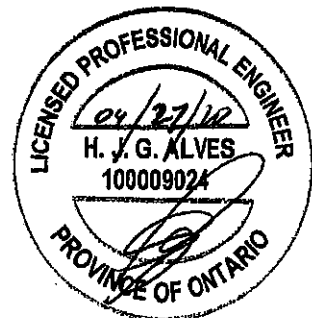

Structural component only
DWG# T-2007177

JOB NAME 408170	TRUSS NAME T49	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:27 2020 Page 1
ID:K?TPdhgi0npl1q/YdbWOFzIdaG-HnXIOJKxeQr1QWf6zvZb0Wx4kDry?IGPmDNozNB1Q

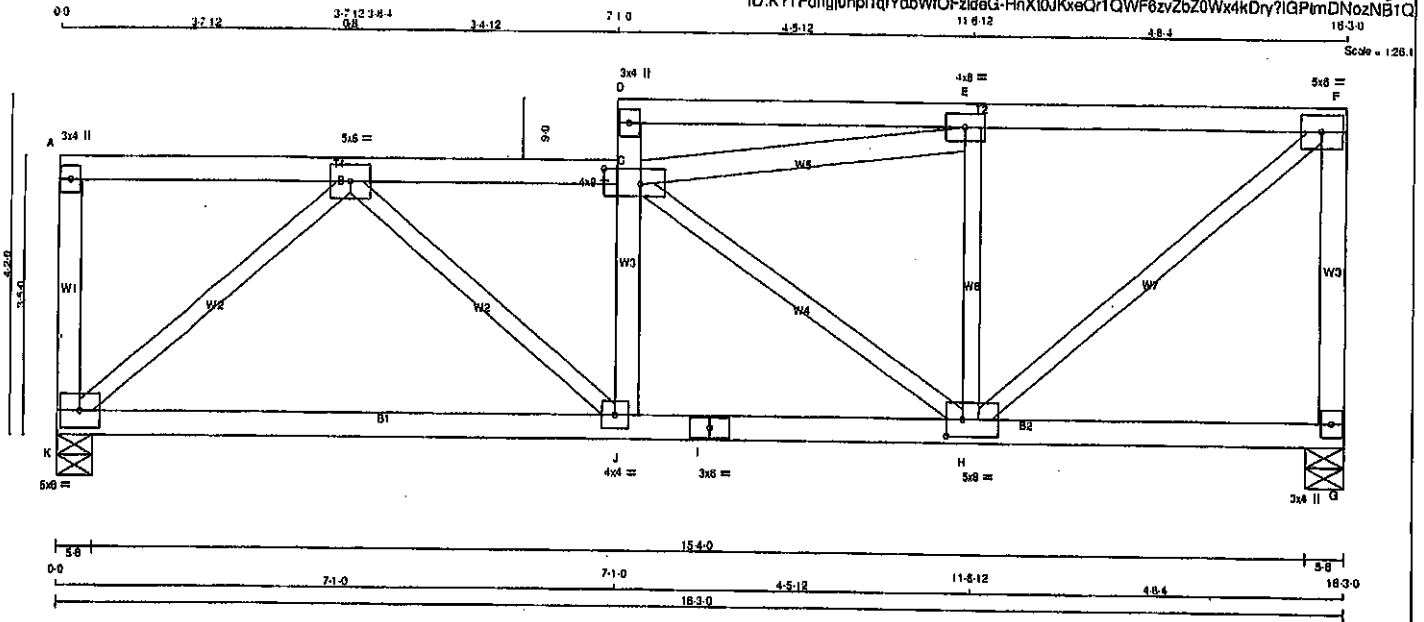

TOTAL WEIGHT = 3 X 72 = 216 lb (M/R)

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
K - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
J - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
G - F	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
C - E	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMV+p	MT20	3.0	4.0	
B	TMVW-1	MT20	5.0	8.0	
C	TMVW-1	MT20	4.0	9.0	2.25 5.50
D	TMV+p	MT20	3.0	4.0	
E	TMVW-1	MT20	4.0	8.0	
F	TMVW-1	MT20	5.0	8.0	
G	BMV1+p	MT20	3.0	4.0	
H	BMVW-1	MT20	5.0	8.0	2.50 2.50
I	BS-1	MT20	3.0	8.0	
J	BMVW-1	MT20	4.0	4.0	
K	BMVW-1	MT20	5.0	8.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING.

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
K	1079	0	1079	0
G	1079	0	1079	0

UNFACTORED REACTIONS

1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED					
K	780	418/0	0/0	0/0	384/0	0/0
G	780	418/0	0/0	0/0	384/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
K-A	-183/0	0.0	0.0 0.04 (1)	7.81	K-B	-1328/0	0.85 (1)
A-B	0/0	-114.3	-114.3 0.32 (1)	10.00	B-J	0/538	0.18 (1)
B-C	-1418/0	-114.3	-114.3 0.37 (1)	4.47	C-E	-861/0	0.30 (1)
J-C	-228/0	0.0	0.0 0.08 (1)	7.81	C-H	-489/0	0.30 (1)
C-D	-183/0	0.0	0.0 0.09 (1)	7.81	H-E	-471/0	0.18 (1)
D-E	-88/0	-114.3	-114.3 0.51 (1)	8.25	H-F	0/1303	0.39 (1)
E-F	-1004/0	-114.3	-114.3 0.85 (1)	4.81			
G-F	-1039/0	0.0	0.0 0.37 (1)	8.91			
K-J	0/1013	-18.5	-18.5 0.41 (4)	10.00			
J-I	0/1402	-18.5	-18.5 0.48 (4)	10.00			
I-H	0/1402	-18.5	-18.5 0.48 (4)	10.00			
H-G	0/0	-18.5	-18.5 0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 15.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 48.0 PSF

SPACING = 24.0 IN./C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSK: TC=0.55/1.00 (E-F:1), GC=0.48/1.00 (H-J:4),
WB=0.65/1.00 (B-K:1), SS=0.34/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1686


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (C) (INPUT = 0.80)
JSI METAL= 0.82 (I) (INPUT = 1.00)




Structural component only
DWG# T-2007178

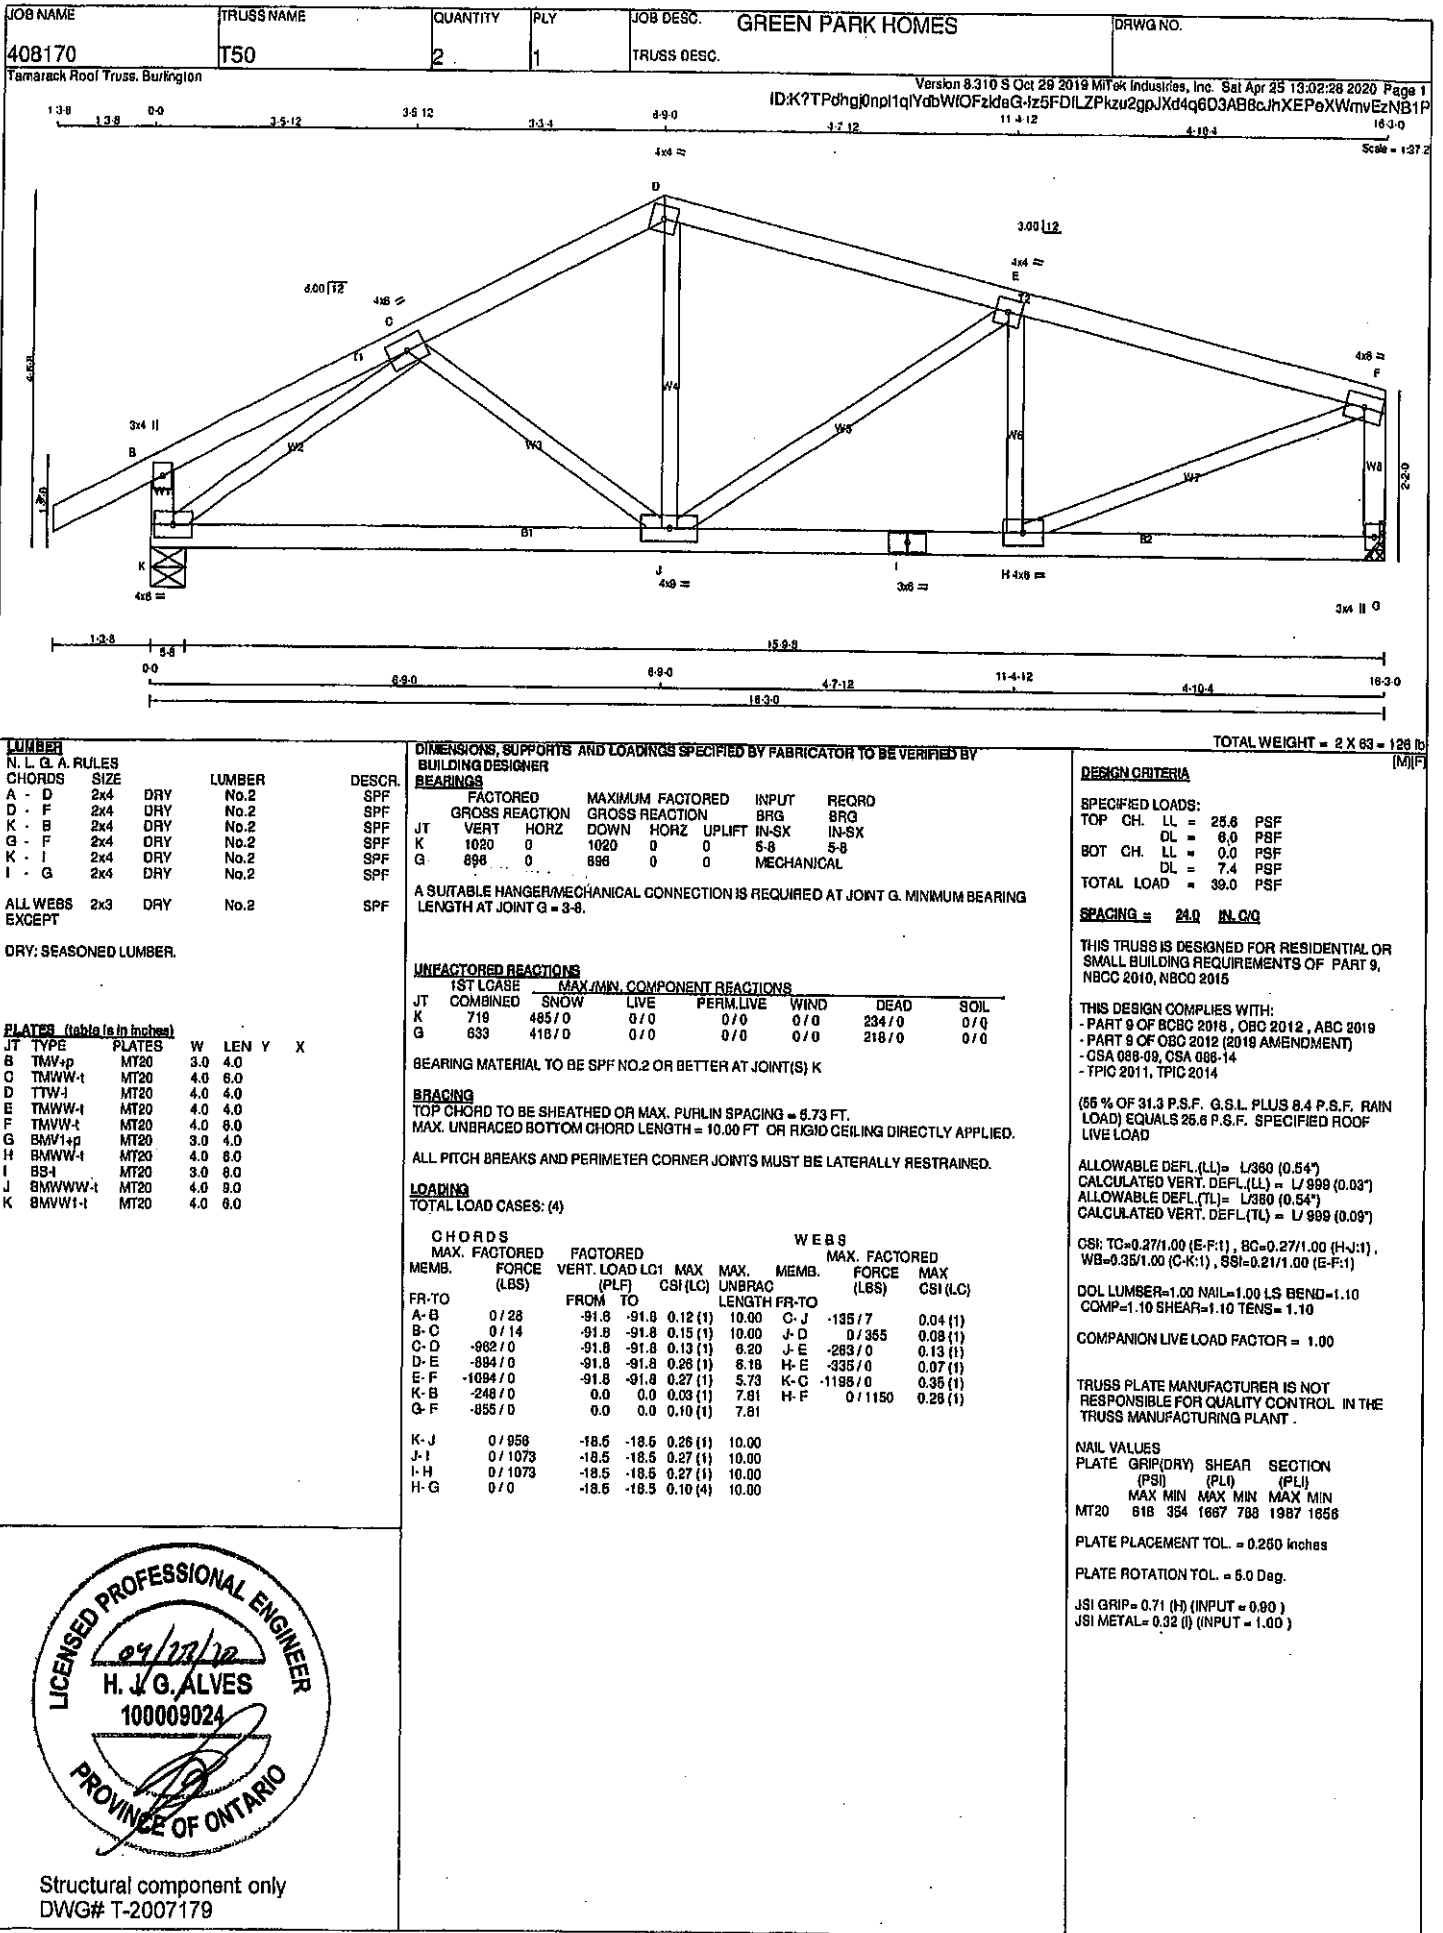

JOB NAME 408170	TRUSS NAME T51	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITEX Industries, Inc. Sat Apr 25 13:02:20 2020 Page 1
 ID:K?TPdhgJ0npl1qYdbWIOFzIdeG-D9dR?MBA25IfpOV4Kb3eRbKcYx2QzGZIBFKSgzNB1C

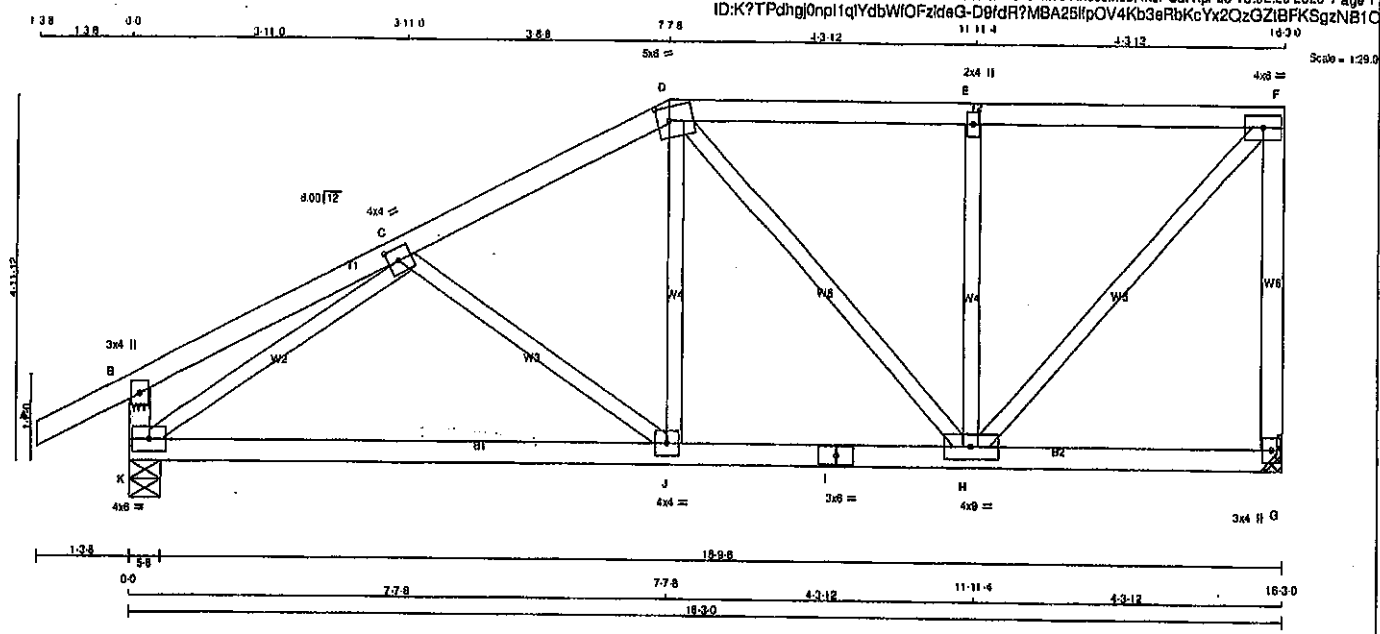

TOTAL WEIGHT = 70 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
K - B	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
 EXCEPT
 DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMWV-t	MT20	4.0	4.0	2.00	1.75
D TTWV-m	MT20	5.0	8.0	2.25	2.00
E TMW+w	MT20	2.0	4.0		
F TMWV-t	MT20	4.0	8.0		
G BMV1+p	MT20	3.0	4.0		
H BMWVW-t	MT20	4.0	9.0		
I BS-t	MT20	3.0	8.0		
J BMWV-t	MT20	4.0	4.0		
K BMWV-t	MT20	4.0	9.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	HORZ	DOWN	HORZ
UPLIFT	IN-SX	IN-SX	MECHANICAL
G 888	0	888	0
K 1020	0	1020	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3.8.

UNFACTORED REACTIONS							
1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
G	833	416 / 0	0 / 0	0 / 0	0 / 0	218 / 0	0 / 0
K	719	485 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.21 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	G-J	-215 / 0	0.08 (1)
B-C	0 / 17	-91.8	-91.8 0.20 (1)	10.00	J-D	0 / 288	0.08 (1)
C-D	-801 / 0	-91.8	-91.8 0.22 (1)	5.21	D-H	-210 / 0	0.14 (1)
D-E	-654 / 0	-91.8	-91.8 0.29 (1)	5.25	H-E	-488 / 0	0.19 (1)
E-F	-654 / 0	-91.8	-91.8 0.29 (1)	5.25	H-F	0 / 981	0.22 (1)
F-G	-653 / 0	0.0	0.0 0.35 (1)	7.81	K-C	-1192 / 0	0.43 (1)
G-H	-281 / 0	0.0	0.0 0.03 (1)	7.81			
K-J	0 / 985	-18.5	-18.5 0.30 (4)	10.00			
J-I	0 / 798	-18.5	-18.5 0.30 (4)	10.00			
I-H	0 / 798	-18.5	-18.5 0.30 (4)	10.00			
H-G	0 / 0	-18.5	-18.5 0.08 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBC 2010, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 08-09, CSA 08-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.64")
 CALCULATED VERT. DEFL.(LL) = L/989 (0.02")
 ALLOWABLE DEFL.(TL) = L/360 (0.64")
 CALCULATED VERT. DEFL.(TL) = L/989 (0.12")

CS1: TC=0.35/1.00 (F-G:1), BC=0.30/1.00 (J-K:4), WB=0.43/1.00 (C-K:1), SS=0.19/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (C) (INPUT = 0.80)
 JSI METAL = 0.40 (C) (INPUT = 1.00)




Structural component only
 DWG# T-2007180

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	G52	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 13:02:13 2020 Page 1
ID:K7TPdghiUnpl1q1YdbWfOFzIdaG-h4ha4W99x740lMAQ9zJ73x105YlqpiCBiNU/czNB1e

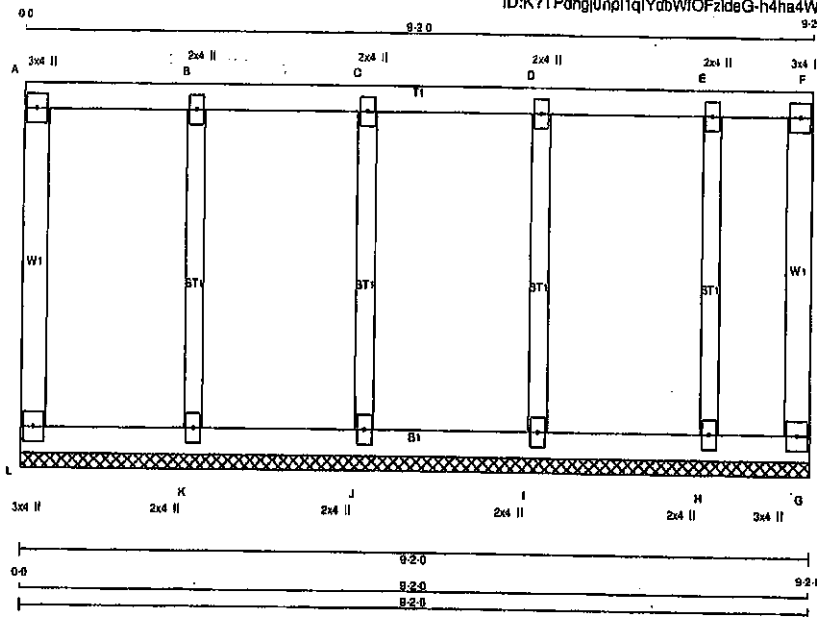

Scale: 1/2\"/>

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES					
L - A	2x4	DRY	No.2	SPF	
A - F	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
L - G	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
ALL GABLE WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					
GABLE STUDS SPACED AT	2-0-0	OC.			

PLATES (tablets in inches)	W	LEN	Y	X
JT TYPE				
A TMV+p	MT20	3.0	4.0	
B, C, D, E				
B TMW+w	MT20	2.0	4.0	
F TMV+p	MT20	3.0	4.0	
G BMV1+p	MT20	3.0	4.0	
H, I, J, K				
H BMW1+w	MT20	2.0	4.0	
L BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER
PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO						FR-TO			
L-A	-100 / 0	0.0	0.0	0.02 (1)	7.81	K-B	-245 / 0	0.09 (1)	
A-B	-4 / 0	-114.3	-114.3	0.09 (1)	10.00	J-C	-224 / 0	0.08 (1)	
B-C	-4 / 0	-114.3	-114.3	0.09 (1)	10.00	I-D	-238 / 0	0.08 (1)	
C-D	-4 / 0	-114.3	-114.3	0.07 (1)	10.00	H-E	-188 / 0	0.08 (1)	
D-E	-4 / 0	-114.3	-114.3	0.07 (1)	10.00				
E-F	-4 / 0	-114.3	-114.3	0.09 (1)	10.00				
G-F	-54 / 0	0.0	0.0	0.02 (1)	7.81				
L-K	0 / 4	-18.5	-18.5	0.02 (4)	10.00				
K-J	0 / 4	-18.5	-18.5	0.02 (4)	10.00				
J-I	0 / 4	-18.5	-18.5	0.02 (4)	10.00				
I-H	0 / 4	-18.5	-18.5	0.02 (4)	10.00				
H-G	0 / 4	-18.5	-18.5	0.01 (4)	10.00				

TOTAL WEIGHT = 41 lb (M) (R)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
DL	= 15.0	PSF	
BOT CH.	LL	= 0.0	PSF
DL	= 7.4	PSF	
TOTAL LOAD	= 48.0	PSF	

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS1: TC=0.02/1.00 (B-C:1), BC=0.02/1.00 (J-K:4), WB=0.09/1.00 (B-K:1), SS=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


MAIL VALUES

PLATE GRIP (DRY)	SHEAR SECTION
(PSI)	(PLI)
MAX MIN	MAX MIN
MT20	618 354 1997 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.17 (B) (INPUT = 0.90)
JSI METAL = 0.07 (K) (INPUT = 1.00)

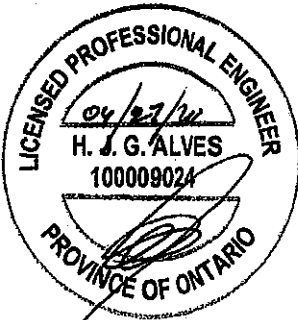


Structural component only
DWG# T-2007166

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T53S	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 13:02:30 2020 Page 1
ID:k?TPdhgJ0npl1qYdbwIOFzIdaG-hLC0eLNpxLDcHzzhe26IBa8YnyLF9WNI5r?1_7zNB1N

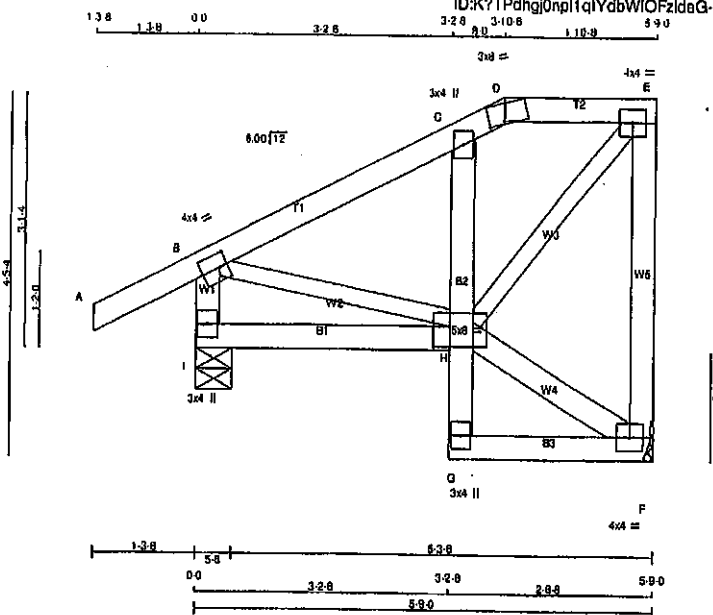

Scale = 1:25.0

LUMBER	CHORDS	SIZE	DRY	No.2
A - D	2x4	DRY	No.2	
D - E	2x4	DRY	No.2	
F - E	2x4	DRY	No.2	
I - B	2x4	DRY	No.2	
I - H	2x4	DRY	No.2	
G - C	2x4	DRY	No.2	
G - F	2x4	DRY	No.2	

ALL WEBS	EXCEPT	SIZE	DRY	No.2
B - H	2x3	DRY	No.2	
H - E	2x3	DRY	No.2	

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	4.0	2.00	1.25
C	TMV-p	MT20	3.0	4.0		
D	TT-m	MT20	3.0	6.0	0.50	2.50
E	TMVW-1	MT20	4.0	4.0		
F	BMVW1-I	MT20	4.0	4.0		
G	BMV-p	MT20	3.0	4.0		
H	BMVWVW-I	MT20	6.0	8.0	3.00	2.50
I	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	302	0	302	0
I	457	0	457	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	214	138 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	75 / 0	0 / 0
I	320	225 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	95 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED
MEMB.	FORCE	VERT.	LOAD	LC1	MAX	MAX.	MEMB.	FORCE
	(LBS)	(PLF)		(LC)	(LBS)			(LBS)
FR-TO		FROM	TO			FR-TO		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	H-F	-10 / 0	0.00 (1)
B-C	-217 / 0	-91.8	-91.8	0.14 (1)	8.25	B-H	0 / 153	0.03 (1)
C-D	-200 / 0	-91.8	-91.8	0.05 (1)	8.25	H-E	0 / 247	0.08 (1)
D-E	-187 / 0	-91.8	-91.8	0.03 (1)	8.25			
F-E	-273 / 0	0.0	0.0	0.03 (1)	7.81			
I-B	-420 / 0	0.0	0.0	0.04 (4)	7.81			
I-H	0 / 41	-18.5	-18.5	0.05 (4)	10.00			
G-H	0 / 25	0.0	0.0	0.02 (1)	10.00			
H-C	-188 / 0	0.0	0.0	0.04 (1)	7.81			
G-F	0 / 16	-18.5	-18.5	0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (B-C:1), BC=0.05/1.00 (H-I:4), WB=0.06/1.00 (E-H:1), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.38 (H) (INPUT = 0.80)
JSI METAL = 0.13 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007181

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T54S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 13:02:31 2020 Page 1
ID:K7TPdhqj0npl1qYdbWIOFzideG-9YmOrgNRhLTv7YICieXkshknMhguyRrKvKRWZzNB1M

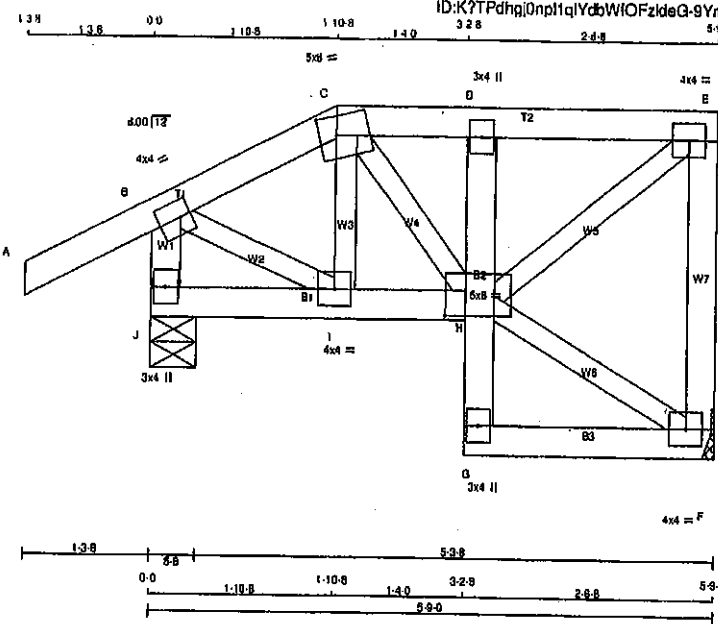

Scale = 1/2" = 1'-0"

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
J - L	2x4	DRY	No.2	SPF	
M - O	2x4	DRY	No.2	SPF	
P - R	2x4	DRY	No.2	SPF	
S - T	2x4	DRY	No.2	SPF	
U - V	2x4	DRY	No.2	SPF	
W - X	2x4	DRY	No.2	SPF	
Y - Z	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
B TMVW-1	MT20	4.0	4.0	2.00	1.25	
C TTWW-m	MT20	5.0	8.0	2.25	2.00	
D TMVW-p	MT20	3.0	4.0			
E TMVW-1	MT20	4.0	4.0			
F BMVW-1	MT20	4.0	4.0			
G BMVW-p	MT20	3.0	4.0			
H BMVWW-1	MT20	8.0	8.0	3.00	2.50	
I BMVW-1	MT20	4.0	4.0			
J BMVW-p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	302	0	302	0
J	456	0	456	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS	1ST LCASE	MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	214	139/0	0/0	0/0	0/0	75/0	0/0
J	320	225/0	0/0	0/0	0/0	95/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. UNBRACED LENGTH FR-TO	MEMB. FORCE (LBS)
A-B	0/28	-91.8	-91.8 0.12 (1)	10.00
B-C	-240/0	-91.8	-91.8 0.12 (1)	6.25
C-D	-246/0	-91.8	-91.8 0.05 (1)	6.25
D-E	-241/0	-91.8	-91.8 0.07 (1)	6.25
E-F	-276/0	0.0	0.0 0.05 (1)	7.81
F-G	-439/0	0.0	0.0 0.04 (1)	7.81
J-I	0/0	-18.5	-18.5 0.02 (4)	10.00
I-H	0/193	-18.5	-18.5 0.04 (1)	10.00
G-H	0/25	0.0	0.0 0.02 (1)	10.00
H-D	-219/0	0.0	0.0 0.01 (1)	7.81
G-F	0/8	-18.5	-18.5 0.03 (4)	10.00

TOTAL WEIGHT = 31 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.01")

CSK TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (H-I:1), WB=0.07/1.00 (E-H:1), SS=0.10/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.33 (B) (INPUT = 0.80)
JSI METAL = 0.13 (B) (INPUT = 1.00)

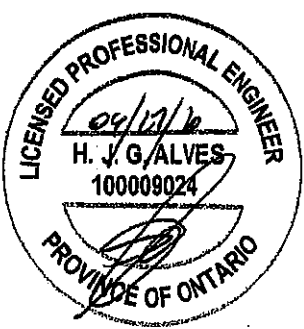

Structural component only
DWG# T-2007182

JOB NAME 408170	TRUSS NAME T55	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:32 2020 Page 2 ID:K?TPdngi0npl1qIYdbWIOFzIdeG-dkKm30CgSzTJWH74mT9mG3DvHI 9dNX?Z9U 2?zNB1L	

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
F 6MV1+p	MT20	3.0	8.0		




Structural component only
DWG# T-2007183

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T56	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:33 2020 Page 1
ID:K7TPdHgJ0npl1qYdbWIOFzIdG-6wu8GMFIDGbA8RIGJAg7pHm499FsMnS8opDXbRzNB1K

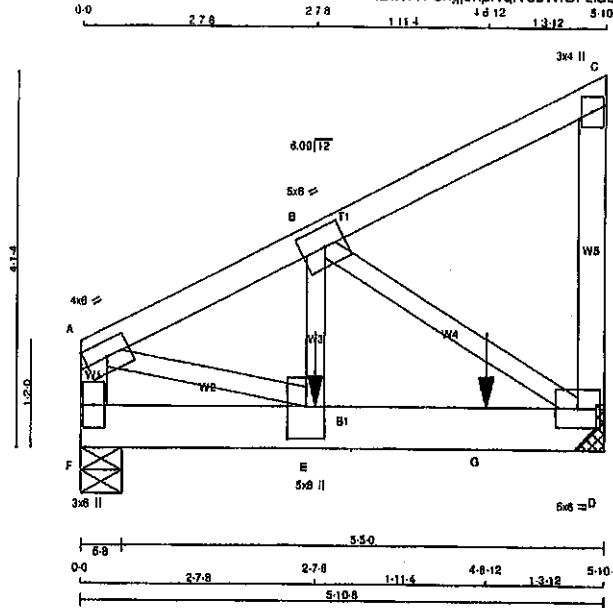

Scale = 1/2" = 1'-0"

LUMBER	N. L. G. A. RULES	LUMBER	DESCR.
CHORDS	SIZE	DRY	No.2
F - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F - A	12	TOP
A - C	12	TOP
C - D	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D	12	SIDE (549.3)
WEBS : (0.122"x3") SPIRAL NAILS		
B - E	2	SIDE (269.5)
2x3	1	8

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
A TMVW-t	MT20	4.0	8.0	2.50	2.75	Edge
B TMVW-t	MT20	5.0	8.0	2.50	2.75	Edge
C TMVW-p	MT20	3.0	4.0			
D BMVW-t	MT20	5.0	8.0			
E BMVW-t	MT20	5.0	8.0	4.25	2.50	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	2334	0	2334	0
D	2733	0	2733	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4'-0".

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	1648	1103 / 0	0 / 0	0 / 0	0 / 0	0 / 0	543 / 0	0 / 0
D	1929	1280 / 0	0 / 0	0 / 0	0 / 0	0 / 0	639 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX	MEMB.	MAX. FACTORED	MAX
MEMB.	FORCE	VERT. LOAD	LC1	MAX	MAX	MEMB.	FORCE	MAX	
(LBS)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)	
FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO	
F-A	-2316 / 0	0.0	0.0	0.13 (1)	7.37	A-E	0 / 2888	0.38 (1)	
A-B	-3101 / 0	-91.8	-91.8	0.08 (1)	5.20	E-B	0 / 2880	0.38 (1)	
B-C	-5 / 0	-91.8	-91.8	0.08 (1)	10.00	B-D	-3393 / 0	0.42 (1)	
D-C	-138 / 0	0.0	0.0	0.02 (1)	7.81				
F-E	0 / 0	-18.5	-18.5	0.01 (4)	10.00				
E-G	0 / 2779	-18.5	-18.5	0.57 (1)	10.00				
G-D	0 / 2779	-18.5	-18.5	0.57 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	2-7-8	-3101	-3101	---	BACK	VERT	TOTAL	---	C1
G	4-6-12	-1318	-1318	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 29 = 57 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.04")

CS: TC=0.13/1.00 (A-F:1), BC=0.57/1.00 (D-E:1),
WB=0.42/1.00 (B-D:1), SS=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 768 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (E) (INPUT = 0.80)
JSI METAL = 0.50 (E) (INPUT = 1.00)



Structural component only
DWG# T-2007184 1/2

CONTINUED ON PAGE 2


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T56	1	2	GREEN PARK HOMES	
Temerack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 13:02:33 2020 Page 2
ID:K?TPdhaJOnpl1qlYdbWIOFzldaG-5wu8GMPIIDGbA8RIGJAg?pHm499FsMnS8opDXbRzNB1K

PLATES (table is in inches)


JT TYPE	PLATES	W	LEN	Y	X
F	BMV1-p	MT20	3.0	8.0	

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

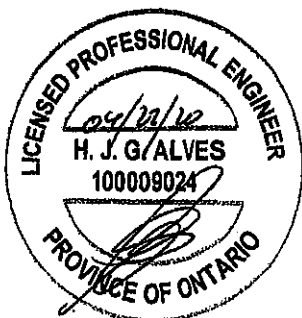

Structural component only
DWG# T-2007184 3/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	PB1	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:46 2020 Page 1					
ID:DMCubINVR6TstFoe31v6f_zns11-PDfyPME2p5aIfMuAaG4kD6h8P9Gw?nTyvpaZzNBRN					
Scale = 1:23.3					

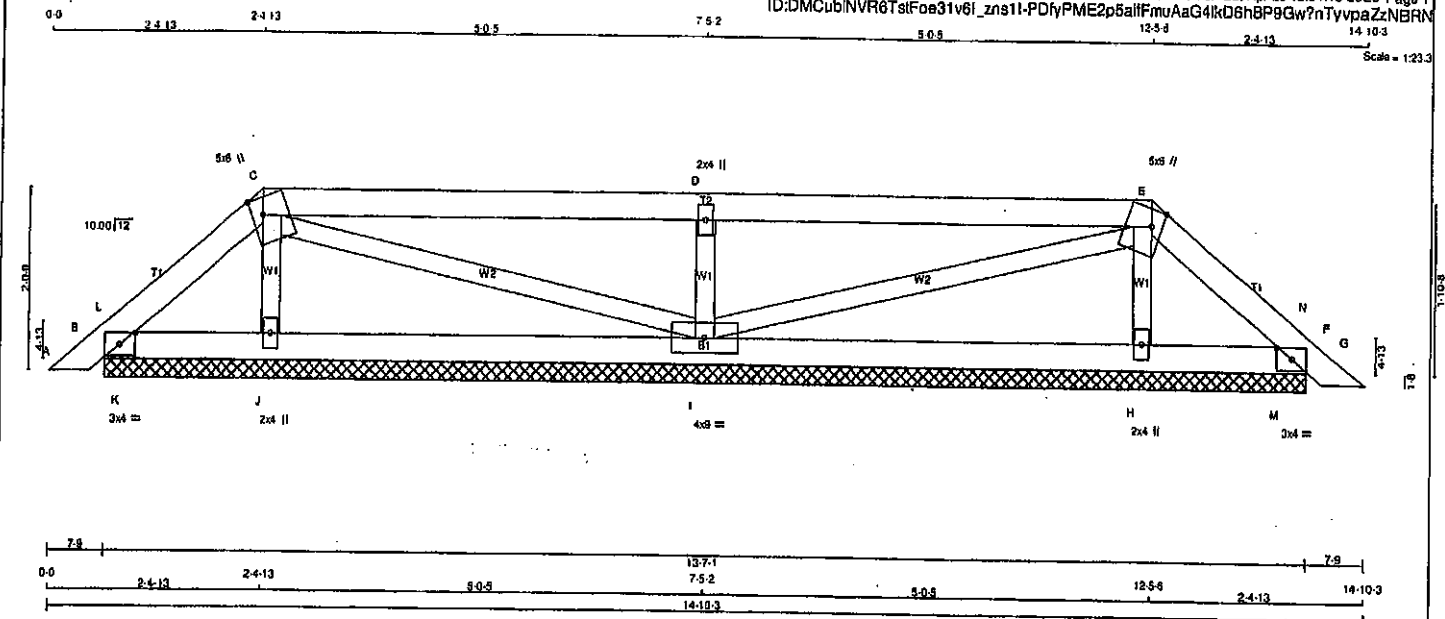

LUMBER				DESIGN CRITERIA			
N. L. G. A. RULES				TOTAL WEIGHT = 3 X 48 = 136 lb			
CHORDS	SIZE	DRY	LUMBER	SPECIFIED LOADS:			
A - C	2x4	DRY	No.2	TOP CH. LL = 25.6 PSF			
C - E	2x4	DRY	No.2	DL = 9.0 PSF			
E - G	2x4	DRY	No.2	BOT CH. LL = 0.0 PSF			
B - F	2x4	DRY	No.2	DL = 7.4 PSF			
ALL WEBS 2x3 DRY				TOTAL LOAD = 39.0 PSF			
DRY: SEASONED LUMBER.				SPACING = 24.0 IN. C/C			

PLATES (table in inches)	W	LEN	Y	X
JT TMB1-I	MT20	3.0	4.0	1.50 2.00
B TMB1-I	MT20	5.0	6.0	2.25 1.50
C TMB1-I	MT20	2.0	4.0	
D TMB1-I	MT20	5.0	6.0	2.25 1.50
E TMB1-I	MT20	3.0	4.0	1.50 2.00
F TMB1-I	MT20	2.0	4.0	
G TMB1-I	MT20	4.0	9.0	
H TMB1-I	MT20	2.0	4.0	
I TMB1-I	MT20	2.0	4.0	
J TMB1-I	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
		GROSS REACTION		GROSS REACTION		BRG		BRG	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
B	169	0	169	0	0	13-7-1	13-7-1		
F	169	0	169	0	0	13-7-1	13-7-1		
J	288	0	288	0	0	13-7-1	13-7-1		
I	683	0	683	0	0	13-7-1	13-7-1		
H	288	0	288	0	0	13-7-1	13-7-1		

UNFACTORED REACTIONS									
		1ST LOOSE		MAX/MIN. COMPONENT REACTIONS					
		COMBINED		SNOW		LIVE		PERM. LIVE	
JT									
B	118	93/0		0/0		0/0		23/0	
F	118	93/0		0/0		0/0		23/0	
J	207	118/0		0/0		0/0		89/0	
I	481	327/0		0/0		0/0		154/0	
H	207	118/0		0/0		0/0		89/0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F, J, I, H


BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)		MAX. FACTORED LENGTH (LBS)	MEMB.		MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO			FROM	TO	UNBRACED LENGTH (LBS)	FR-TO			
A-B	0 / 14		-91.8	-91.8	0.02 (1)	10.00	J-C	-194 / 0	0.03 (1)
B-L	-31 / 4		-91.8	-91.8	0.01 (1)	6.25	C-I	-22 / 0	0.01 (1)
L-C	-80 / 0		-91.8	-91.8	0.03 (1)	8.25	I-D	-576 / 0	0.08 (1)
C-D	-8 / 0		-91.8	-91.8	0.39 (1)	10.00	E-E	-22 / 0	0.01 (1)
D-E	-8 / 0		-91.8	-91.8	0.39 (1)	10.00	H-E	-194 / 0	0.03 (1)
E-N	-60 / 0		-91.8	-91.8	0.03 (1)	6.25	K-L	-121 / 0	0.00 (1)
N-F	-31 / 4		-91.8	-91.8	0.01 (1)	6.25	M-N	-121 / 0	0.00 (1)
F-G	0 / 14		-91.8	-91.8	0.02 (1)	10.00			
B-K	0 / 42		-18.5	-18.5	0.04 (1)	10.00			
K-J	0 / 42		-18.5	-18.5	0.07 (4)	10.00			
J-I	0 / 29		-18.5	-18.5	0.10 (4)	10.00			
I-H	0 / 29		-18.5	-18.5	0.10 (4)	10.00			
H-M	0 / 42		-18.5	-18.5	0.07 (4)	10.00			
M-F	0 / 42		-18.5	-18.5	0.04 (1)	10.00			

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	PB20	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 12:49:22 2020 Page 1
ID:K7TPdHgJ0npl1qYdbWIOFzIdG-mib8FuqXVExPlkFUY_VFTV(TIPkW7)jvF6AJozNBDH

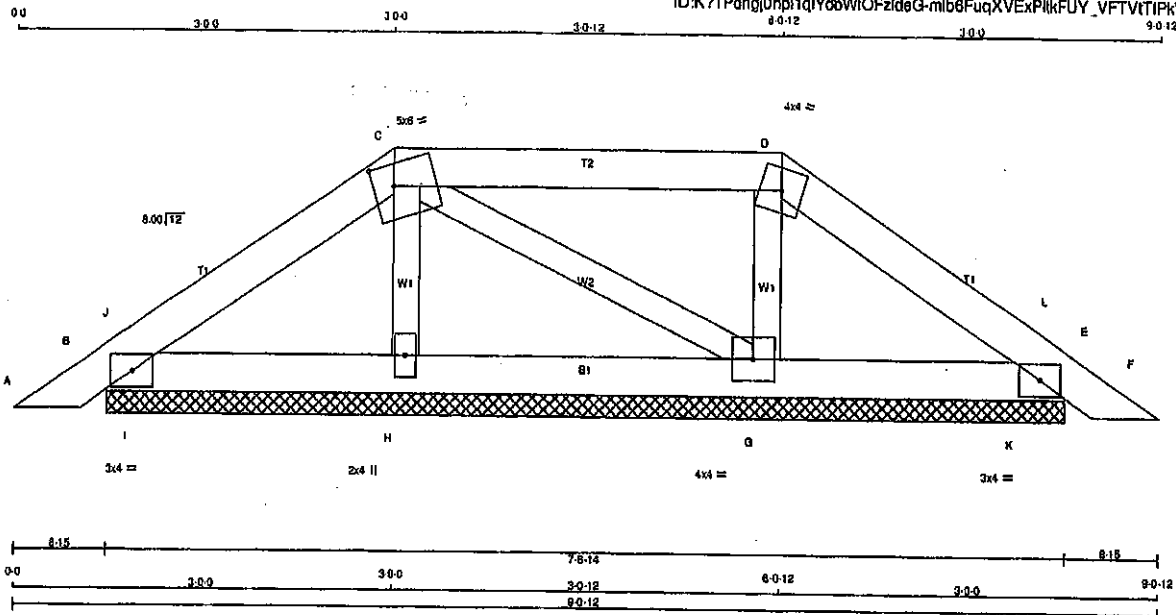

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - D	2x4	DRY	No.2	SPF		
D - F	2x4	DRY	No.2	SPF		
B - E	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
DRY: SEASONED LUMBER.						

PLATES (tablets in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TM814	MT20	3.0	4.0			
C	TTWW-m	MT20	5.0	8.0	2.00	2.00	
D	TTWW-m	MT20	4.0	4.0			
E	TM814	MT20	3.0	4.0			
G	BMWW14	MT20	4.0	4.0			
H	BMWW14	MT20	2.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	UPLIFT	IN-SX
B	221	0	0	7-6-14
E	209	0	0	7-6-14
H	248	0	0	7-6-14
G	280	0	0	7-6-14

UNFACTORED REACTIONS	1ST LCASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	SNOW
B	154	113/0
E	148	106/0
H	176	109/0
G	198	127/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LG1 MAX (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0/15	-91.8 -91.8 0.03 (1)	H-C	-176/0
B-J	-63/0	-91.8 -91.8 0.01 (1)	C-G	-21/0
J-C	-74/0	-91.8 -91.8 0.05 (1)	G-D	-188/0
C-D	-30/0	-91.8 -91.8 0.15 (1)	D-J	-121/0
D-L	-54/0	-91.8 -91.8 0.05 (1)	K-L	-123/0
L-E	-41/0	-91.8 -91.8 0.01 (1)		
E-F	0/15	-91.8 -91.8 0.03 (1)		
B-I	0/80	-18.5 -18.5 0.06 (1)		
I-H	0/80	-18.5 -18.5 0.06 (1)		
H-G	0/48	-18.5 -18.5 0.03 (1)		
G-K	0/43	-18.5 -18.5 0.06 (1)		
K-E	0/43	-18.5 -18.5 0.06 (1)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(85 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.15/1.00 (C-D:1), BC=0.08/1.00 (B-I:1), WB=0.03/1.00 (D-G:1), SSI=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.18 (B) (INPUT = 0.90)
JSI METAL = 0.04 (B) (INPUT = 1.00)

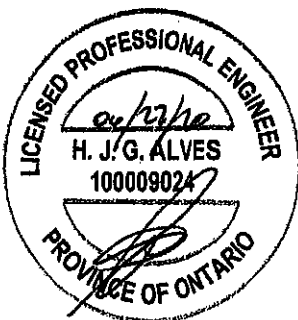

Structural component only
DWG# T-2007144

JOB NAME 408169	TRUSS NAME J20S	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 12:49:21 2020 Page 1
ID:K?TPdngj0npl1qlydbWfOFzIdeG-I2tk2Ypvkxpy7j92wrSGIGzlsv3mg3ZgbMdnLzNBD

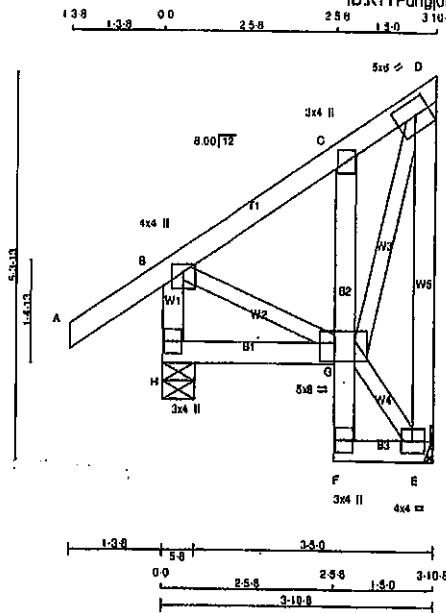

Scale = 1/29.2

LUMBER					
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR	
H - B	2x4	DRY	No.2	SPF	
A - D	2x4	DRY	No.2	SPF	
H - G	2x4	DRY	No.2	SPF	
F - C	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT	E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DRY: SEASONED LUMBER.

PLATES (tablets in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW+p	MT20	4.0	4.0 1.25 2.00
C	TMVW+p	MT20	3.0	4.0
D	TMVW+p	MT20	5.0	8.0 2.50 2.50
E	BMVW+p	MT20	4.0	4.0
F	BMVW+p	MT20	3.0	4.0
G	BMVW+p	MT20	5.0	8.0 3.00 2.50
H	BMVW+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	UPLIFT
H	332	0	332
E	208	0	208

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

1ST CASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
H	232	168 / 0	0 / 0	0 / 0	0 / 0	88 / 0
E	145	95 / 0	0 / 0	0 / 0	0 / 0	50 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	MEMB.
FR-TO				FR-TO			
H-B	-307 / 0	0.0	0.0 (0.03) (1)	B-G	0 / 83	0.02 (1)	
A-B	0 / 35	-91.8	-91.8 0.14 (5)	E-D	-184 / 0	0.05 (1)	
B-C	-83 / 0	-91.8	-91.8 0.07 (1)	G-E	-14 / 0	0.00 (1)	
C-D	-100 / 0	-91.8	-91.8 0.08 (1)	G-D	0 / 220	0.05 (1)	
H-G	0 / 0	-18.5	-18.5 0.04 (4)				
F-G	0 / 12	0.0	0.0 0.02 (1)				
G-C	-218 / 0	0.0	0.0 0.02 (1)				
F-E	0 / 9	-18.5	-18.5 0.01 (4)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 29 = 86 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.10")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.10")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CSI: TC=0.14/1.00 (A-B:5), BC=0.04/1.00 (G-H:4),
WB=0.05/1.00 (D-E:1), SS=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.90)
JSI METAL = 0.07 (C) (INPUT = 1.00)

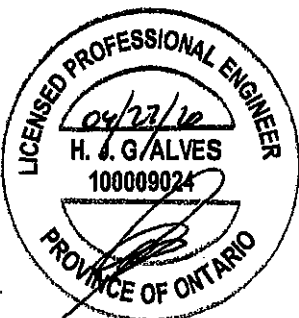


Structural component only
DWG# T-2007143

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	C40	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 6 Oct 28 2019 MITek Industries, Inc. Sat Apr 25 13:02:08 2020 Page 1
ID:K?TPdHgI0np1qIYdbWIOFzdeG-K7h1p806bSjebiTMQj8l?Emz4pp?ZnT2QjCOzNB1

Scale = 1:17.9

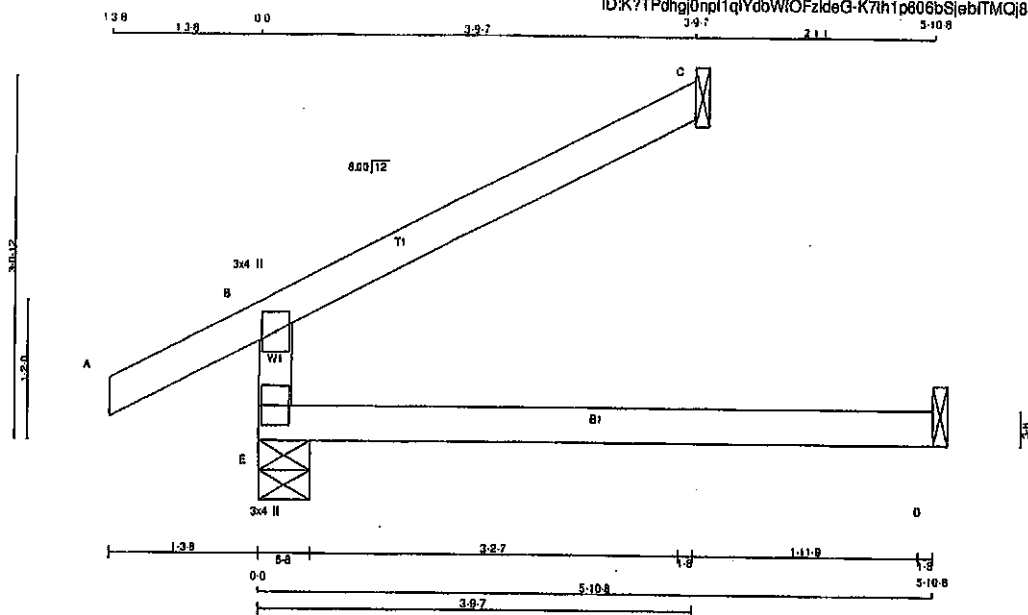

TOTAL WEIGHT = 3 X 14 = 42 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORZ	UPLIFT
E	405	0	405	0
C	130	0	130	0
D	45	0	50	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED						
E	288	180 / 0	0 / 0	0 / 0	0 / 0	98 / 0	0 / 0
C	90	73 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	38 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	LENGTH FR-TO	
E-B	-342 / 0	0.0	0.0	0.13 (4)
A-B	0 / 28	-91.8	-91.8	0.12 (1)
B-C	-19 / 0	-91.8	-91.8	0.22 (1)
E-D	0 / 0	-18.5	-18.5	0.13 (4)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	610 354	1687 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) (INPUT = 0.80)
JSI METAL = 0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007162

JOB NAME 408170	TRUSS NAME C41	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 5 Oct 2019 Mitek Industries, Inc. Sat Apr 26 15:02:09 2020 Page 1	

ID:K?TPdhgjOnpl1qlydbWfOFzIdeC-pJR3E96elvaaGltW7ENrDmzIU9yk01cG4PGkrzNBti

Scale = 1:12.5

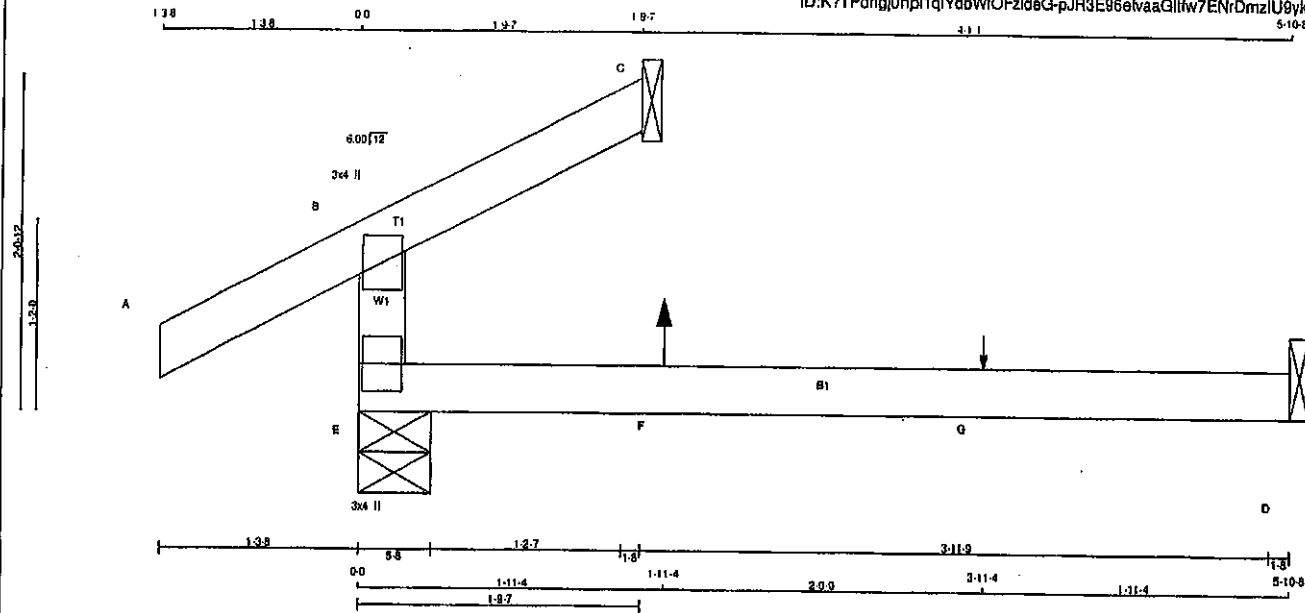

TOTAL WEIGHT = 3 X 12 = 35 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	COMBINED	GROSS REACTION	GROSS REACTION	BRG	BRG
E	284	0	284	0	5-8
C	83	0	83	0	1-8
D	44	0	52	0	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	200	137/0	0/0	0/0	0/0	62/0	0/0
C	48	21/0	0/0	0/0	0/0	25/0	0/0
D	35	0/3	0/0	0/0	0/0	37/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (7)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)
FR-TO			
E-B	-227/0	0.0	0.0 (1) (4)
A-B	0/28	-91.8	-91.8 (1) (4)
B-C	-9/9	-91.8	-91.8 (0) (4)
E-F	0/0	-18.5	-18.5 (1) (4)
F-G	0/0	-18.5	-18.5 (1) (4)
G-D	0/0	-18.5	-18.5 (1) (4)

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LCI	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11-4	7	1	12	BACK	VERT	TOTAL	--	C1
G	3-11-4	1	1	--	BACK	VERT	TOTAL	--	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
	DL = 8.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPO 2011, TPO 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4)

WB=0.00/1.00 (n/a:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.10 (E) (INPUT = 0.80)
JSI METAL = 0.08 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007163

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	C42	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:10 2020 Page 1
ID:K?TPdhgJ0npH1qYdbW/OFzIdeG-HV?SRV7GeCIRuvRrTricNQJ6SuW4TTHmVkb8pHHzNB1h

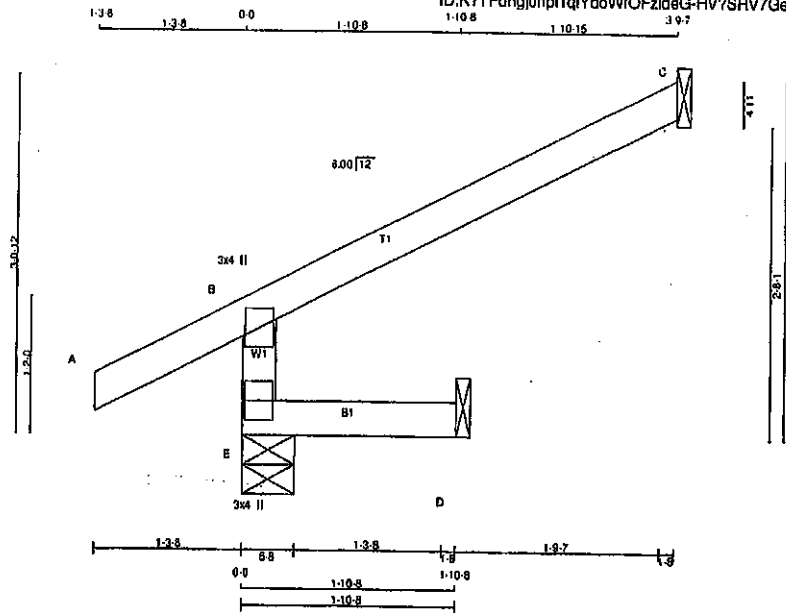

Scale = 1:18.2

LUMBER	N. L. G. A. RULES
CHORDS	SIZE
E - B	2x4 DRY No.2
A - C	2x4 DRY No.2
E - D	2x4 DRY No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
E	381	0	381	0	5-8	5-8
C	130	0	130	0	1-8	1-8
D	16	0	17	0	1-8	1-8

SEE MITEK STANDARD DETAIL 097791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE COMBINED	MAX/MIN. COMPONENT REACTIONS				WIND DEAD	SOIL
		SNOW	LIVE	PERM. LIVE	IN-SX		
E	250	190 / 0	0 / 0	0 / 0	0 / 0	60 / 0	0 / 0
C	90	73 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	12	0 / 0	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. (LC)	MAX. UNBRAC LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRAC LENGTH FR-TO	MAX. (LC)	
FR-TO		FROM TO			FR-TO				
E-B	-342 / 0	0.0	0.0	0.01 (4)	7.81				
A-B	0 / 28	-91.8	-91.8	0.13 (6)	10.00				
B-C	-19 / 0	-91.8	-91.8	0.22 (1)	6.25				
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
BOT CH. LL = 8.0 PSF
DL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABO 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.18")
CALCULATED VERT. DEFL.(LL) = $L/889$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.18")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1997 1688

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)

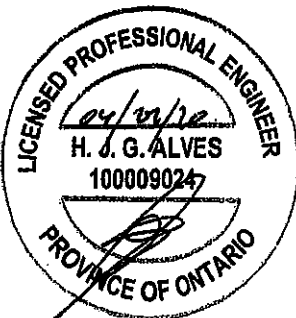

Structural component only
DWG# T-2007164

JOB NAME 408170	TRUSS NAME C43	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:11 2020 Page 1
ID:K?TPdhgJ0np1qYdbWIOFzIdeG-lizqlf8uPWqlV2011YHrwsJqls_CwXvKouNpizNB1g

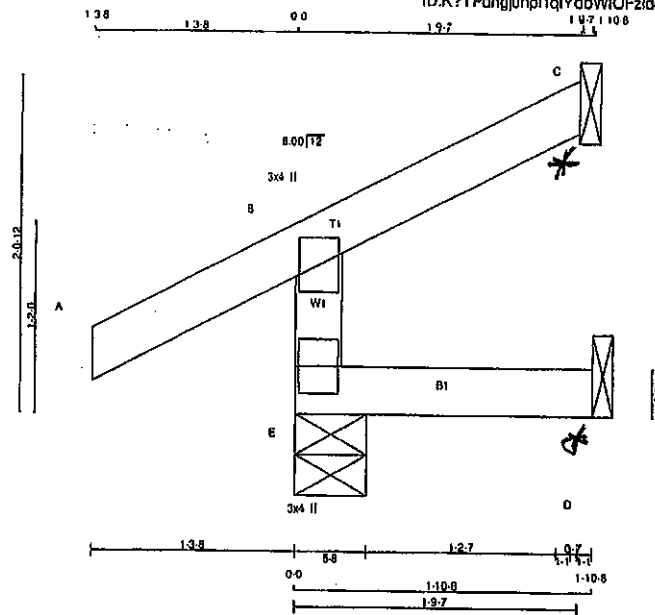

Scale = 1:13.1

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2	
A - C	2x4	DRY	No.2	
E - D	2x4	DRY	No.2	

DRY; SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV4p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	271	0	271	0	0	5-8	5-8
C	45	0	45	0	-23	1-8	1-8
D	8	0	17	0	-2	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	188	141/0	0/0	0/0	0/0	47/0	0/0
C	31	24/-18	0/0	0/0	0/0	7/0	0/0
D	7	0/-8	0/0	0/0	0/0	12/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS				
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LBS)	LC2 MAX (LBS)	UNBRAC LENGTH	MEMB. FORCE (LBS)	MAX. FACTORED FORCE (LBS)	LC1 MAX (LBS)
FR-TO		FROM	TO			FR-TO		
E-B	-244/0	0.0	0.0	0.04 (5)	7.81			
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00			
B-C	-17/0	-91.8	-91.8	0.03 (1)	6.25			
E-D	0/0	-18.5	-18.5	0.04 (5)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 7 = 21 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5).
WB=0.00/1.00 (n/a:0), SS=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)

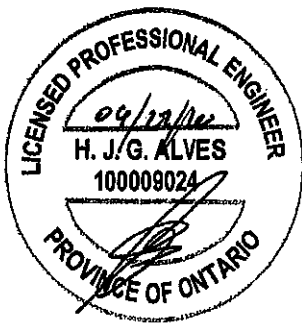

Structural component only
DWG# T-2007165

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.






Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1 1/4" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:

- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options Information on p. 126.

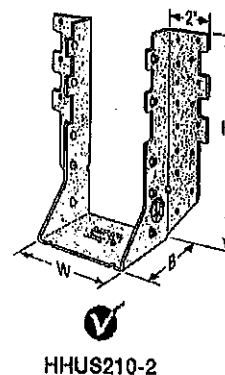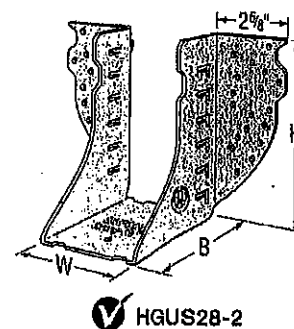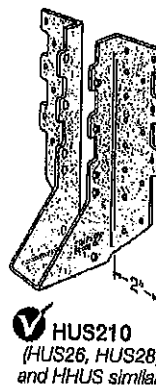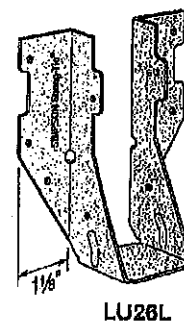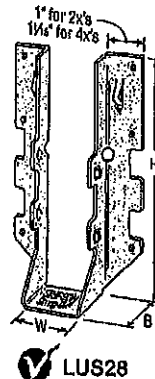

Double-Shear
Nailing
Top View





Double-Shear
Nailing
Side View;
Do not
bend tab



Dome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,680

Typical HUS28
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

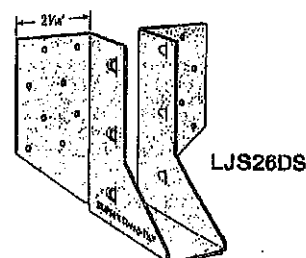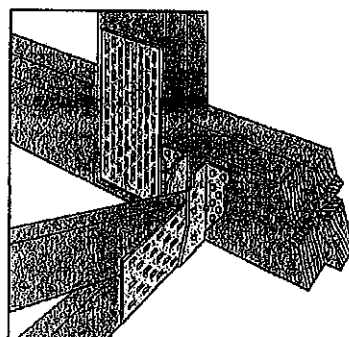

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.82 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
$W < 2"$	Bevel or square cut	0.82 of table value	0.46 of table value
$2" < W < 6"$	Bevel cut	0.67 of table value	0.41 of table value
$2" < W < 6"$	Square cut	0.46 of table value	0.41 of table value
$W > 6"$	Bevel cut	0.75 of table value	0.41 of table value

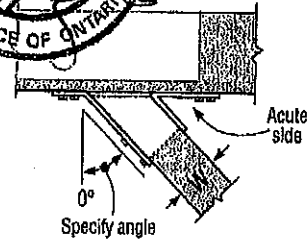

**Top View HHUS Hanger
Skewed Right**
(joist must be bevel cut)
All joist nails installed on the
outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ³	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
								lb.	lb.	lb.	lb.
Single 2x Sizes											
LUS24	18	1 1/8	3 1/4	1 1/4	2 1/4	(4) 10d	(2) 10d	710	1626	845	1155
								3.16	7.23	2.87	5.14
LU24L	22	1 1/8	3	1 1/4	2 1/8	(4) 10d	(2) 10d x 1 1/2"	380	1020	320	726
								1.69	4.54	1.42	3.22
LU26L	22	1 1/8	5	1 1/4	4 1/8	(6) 10d	(4) 10d x 1 1/2"	720	1605	845	1140
								3.20	7.14	2.87	5.07
SS LUS26	18	1 1/8	4 3/4	1 1/4	3 3/4	(4) 10d	(4) 10d	1420	2170	1290	1630
								6.32	9.65	5.74	7.25
HUS28	16	1 1/8	5 3/4	3	3 3/8	(14) 16d	(8) 16d	2705	4940	2065	3875
								11.90	21.97	9.20	17.24
LJS26DS	18	1 1/8	5	3 1/2	4 1/8	(16) 16d	(6) 16d	2055	4265	1480	4115
								9.14	18.97	6.49	18.31
HGUS28	12	1 1/8	5 3/4	5	4 1/8	(20) 16d	(8) 16d	2885	6625	2685	5700
								11.96	28.51	11.96	25.35
LU28L	20	1 1/8	6 3/4	1 1/4	5 1/8	(8) 10d	(8) 10d x 1 1/2"	1140	2185	1020	1550
								5.07	8.72	4.54	6.88
SS LUS28	18	1 1/8	6 3/4	1 1/4	3 3/4	(8) 10d	(4) 10d	1420	2520	1290	1790
								6.32	11.21	5.74	7.96
HUS28	16	1 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3605	5365	2675	4345
								16.04	23.86	11.90	19.33
HGUS28	12	1 1/8	7 1/8	5	6 1/8	(36) 16d	(12) 16d	3310	7675	3310	6900
								14.74	34.19	14.74	30.73
LU210L	20	1 1/8	8	1 1/4	7 1/8	(10) 10d	(8) 10d x 1 1/2"	1140	2495	1020	1770
								5.07	11.10	4.54	7.87
SS LUS210	18	1 1/8	7 1/8	1 1/4	3 3/4	(8) 10d	(4) 10d	1420	2785	1290	2210
								6.32	12.39	5.74	9.83

1. Factored uplift resistances have been increased 16% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/4" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

SIMPSON
Strong-Tie

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ¹	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _g = 1.15) lb.	(K _g = 1.00) lb.	(K _g = 1.15) lb.	(K _g = 1.00) lb.
Double 2x Sizes											
LUS24-2	18	3 3/8	3 3/8	2	1 1/2	(4) 10d	(2) 10d	835 3.71	2020 8.99	590 2.62	1435 6.38
LUS20-2	18	3 3/8	4 3/8	2	4	(4) 10d	(4) 10d	1720 7.65	2595 11.54	1545 6.87	1920 8.54
HHUS26-2	14	3 3/8	5 3/8	3	3 1/2	(14) 10d	(6) 10d	2850 12.68	7335 32.83	2065 9.20	5205 23.15
HGUS26-2	12	3 3/8	5 3/8	4	4 1/2	(20) 10d	(8) 10d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
LUS28-2	18	3 3/8	7	2	4	(6) 10d	(4) 10d	1720 7.65	3325 14.79	1545 6.87	2575 11.45
HHUS28-2	14	3 3/8	7 1/8	3	6 1/2	(22) 10d	(8) 10d	3765 16.75	8940 39.77	2675 11.90	6345 28.22
HGUS28-2	12	3 3/8	7 3/8	4	8 1/2	(36) 10d	(12) 10d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
LUS210-2	18	3 3/8	9	2	8	(8) 10d	(6) 10d	2580 11.48	4500 20.02	2320 10.32	3195 14.21
HHUS210-2	14	3 3/8	9 3/8	3	8	(30) 10d	(10) 10d	4670 26.77	9660 42.97	4235 18.84	7000 31.14
HGUS210-2	12	3 3/8	9 3/8	4	8 1/2	(48) 10d	(16) 10d	6840 30.43	14015 62.34	4855 21.60	10270 45.60
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/8	4	4 1/2	(20) 10d	(8) 10d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
HGUS28-3	12	4 1/8	7 1/4	4	6 1/2	(36) 10d	(12) 10d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
HHUS210-3	14	4 1/8	9	3	7 1/2	(30) 10d	(10) 10d	4670 20.77	9670 43.02	4235 19.84	6865 30.51
HGUS210-3	12	4 1/8	9 1/4	4	8 1/2	(48) 10d	(16) 10d	6840 30.43	14645 65.14	4855 21.60	10400 46.26
Quadruple 2x Sizes											
HGUS26-4	12	6 1/8	5 1/8	4	4 1/2	(20) 10d	(8) 10d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
HGUS28-4	12	6 1/8	7 3/8	4	6 1/2	(36) 10d	(12) 10d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
HHUS210-4	14	6 1/8	8 1/2	3	7 1/2	(30) 10d	(10) 10d	4670 20.77	10155 45.17	4235 18.84	7210 32.07
HGUS210-4	12	6 1/8	9 3/8	4	8 1/2	(48) 10d	(16) 10d	6840 30.43	14645 65.14	4855 21.60	10400 46.26
HGUS212-4	12	6 1/8	10 1/2	4	10 1/2	(56) 10d	(20) 10d	7640 33.98	14995 66.70	5425 24.13	10645 47.35
HGUS214-4	12	6 1/8	12 1/2	4	11 1/2	(66) 10d	(22) 10d	10130 45.06	18400 72.95	7195 32.00	11645 51.80
4x Sizes											
LUS46	18	3 3/8	4 3/8	2	3 3/8	(4) 10d	(4) 10d	1720 7.65	2595 11.54	1545 6.87	1920 8.54
HHUS46	14	3 3/8	5 3/8	3	3 1/2	(14) 10d	(8) 10d	2540 11.30	7335 32.83	2065 9.20	5205 23.15
HGUS46	12	3 3/8	5 3/8	4	4 1/2	(20) 10d	(8) 10d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
LUS48	18	3 3/8	6 3/8	2	3 3/8	(6) 10d	(4) 10d	1720 7.65	3325 14.79	1545 6.87	2575 11.45
HHUS48	14	3 3/8	7 1/8	3	6 1/2	(22) 10d	(8) 10d	3765 16.75	8940 39.77	2675 11.90	6345 28.22
HGUS48	12	3 3/8	7 3/8	4	6 1/2	(36) 10d	(12) 10d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
LUS410	18	3 3/8	8 3/8	2	5 3/8	(8) 10d	(6) 10d	2580 11.48	4500 20.02	2320 10.32	3195 14.21
HGUS410	12	3 3/8	9	4	8 1/2	(48) 10d	(16) 10d	6840 30.43	14015 62.34	4855 21.60	10270 45.60
HGUS412	12	3 3/8	10 1/8	4	10 1/2	(56) 10d	(20) 10d	7640 33.98	14995 66.70	5425 24.13	10645 47.35
HGUS414	12	3 3/8	12 1/8	4	11 1/2	(66) 10d	(22) 10d	10130 45.06	18400 72.95	7195 32.00	11645 61.80



Plated Truss Connectors

See footnotes
on p. 258.

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

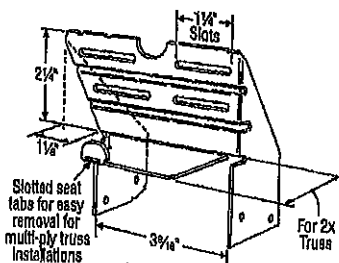


TC24
U.S. Patent 4,932,173

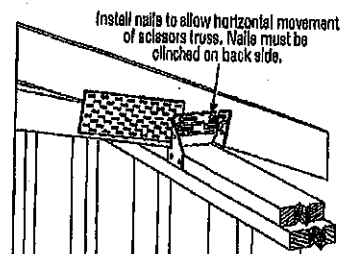


Typical TC24 Installation

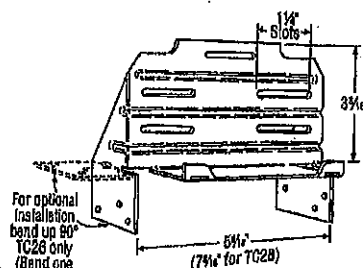

TC26
(TC28 Similar)

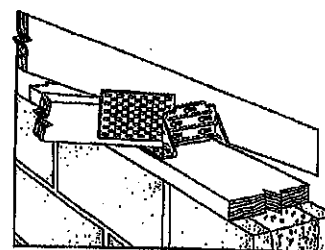

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer (8", 10", 12" Wall Installation Similar)

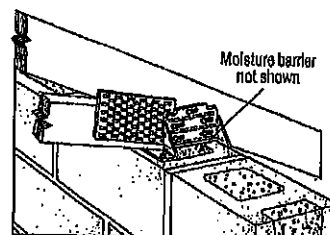

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K ₀ =1.15)	Uplift (K ₀ =1.15)
TC24	(4) 10d	(4) 10d	805	430
TC26	(5) 10d	(5) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K ₀ =1.15)	Uplift (K ₀ =1.15)
TC26	(5) 10d	(8) 10d x 1 1/2"	810	660
	(5) 10d	(8) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.

2. Grout strength is 15 MPa minimum.

3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.

4. TC26 fastened to grouted concrete block with (8) - 3/8" x 2 1/4" Titen screws has a factored uplift resistance of 275 lb.



U.S. & CANADIAN
SIMPSON STRONG-TIE

2201 W. Lincoln Street, Columbus, OH 43260-1099

10000 17th Avenue, Richmond, BC V6V 1K7

(800) 999-5099
strongtie.com

H/TSP**SIMPSON**
Strong-Tie**Seismic and Hurricane Ties (cont.)**

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_F = 1.15$)					
					D.Fir-L			S-P-F		
		To Rafter/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(8) 8d x 1½"	(4) 8d	—	740	685	300	680	485	215
					3.29	3.05	1.33	3.02	2.13	0.96
H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	65
					3.69	0.98	0.33	2.62	0.69	0.24
H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
					3.68	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	180	210
					3.71	0.78	0.93	3.29	0.71	0.93
H3	18	(4) 8d	(4) 8d	—	740	180	265	615	125	190
					3.29	0.80	1.18	2.74	0.58	0.86
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	980	475	—
					6.18	2.98	—	4.40	2.11	—
H8 ^a	18	(6) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.58	—	—
H10A ^a	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	585	290
					7.72	3.54	1.82	6.89	2.61	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.16	5.87	1.91	7.32	3.91	1.36
H10S ^{a,b}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1485	795	315	1040	565	225
					6.62	3.54	1.40	4.63	2.51	1.00
H11Z	18	(8) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
		[2] (12) 8d x 1½"	(15) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
TSP	18	(9) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
					5.76	1.98	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1580	440	—	1105	310	—
					6.94	1.98	—	4.92	1.38	—

- Factored resistances have been increased 16% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.6A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 695 lb. (2.65 kN) for D.Fir-L and 590 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.61 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 8/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.162" dia. x 2½" long, 10d = 0.148" dia. x 9" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

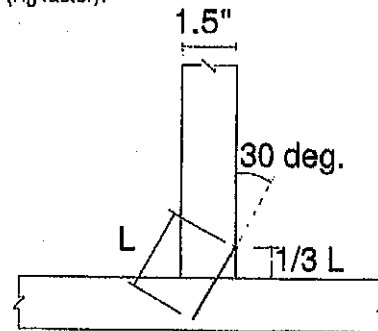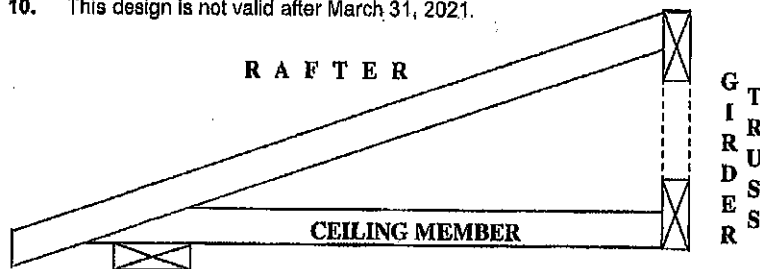


TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (In)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37679H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

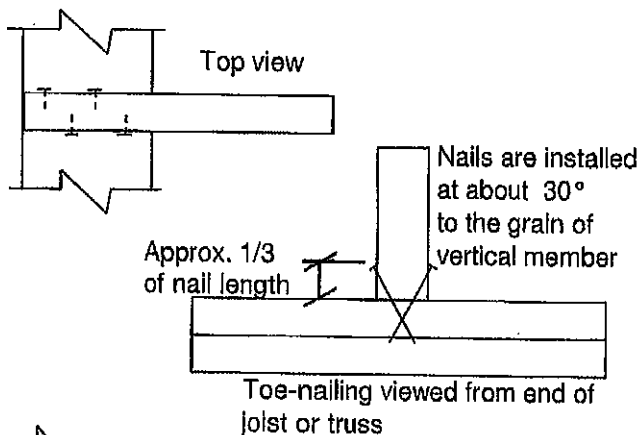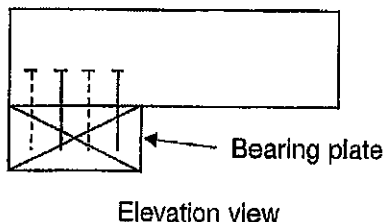


Toe-nailing on 2x4 Bearing Plate

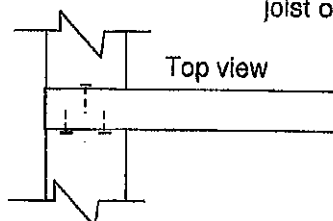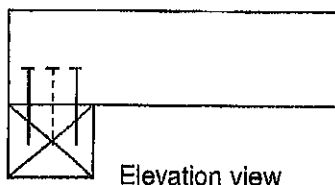

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7


PEO
Certificate No. 10889485.




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint, unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/4" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

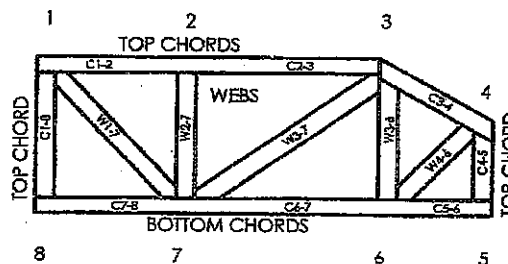

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MTE-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

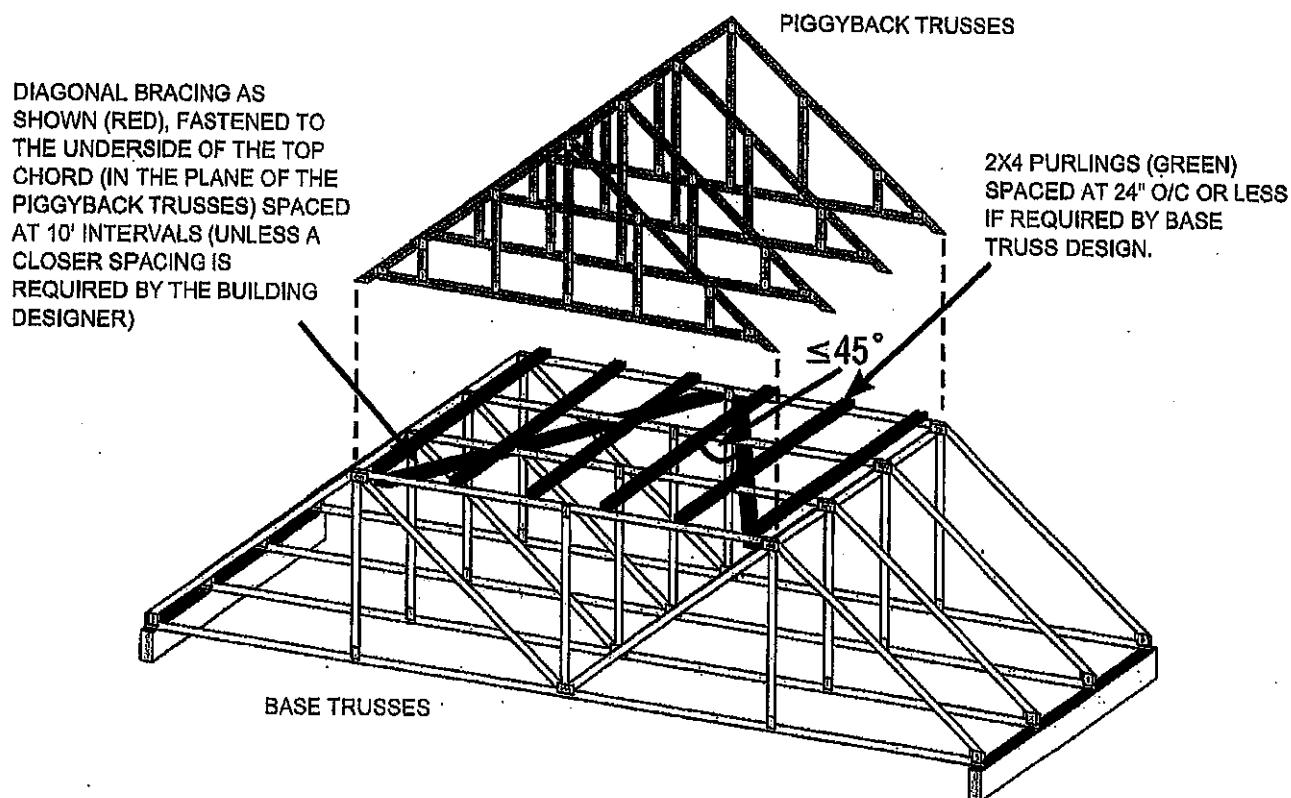

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8- Refer to Mitek sheet M117473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1800218

Feb 09, 2018