


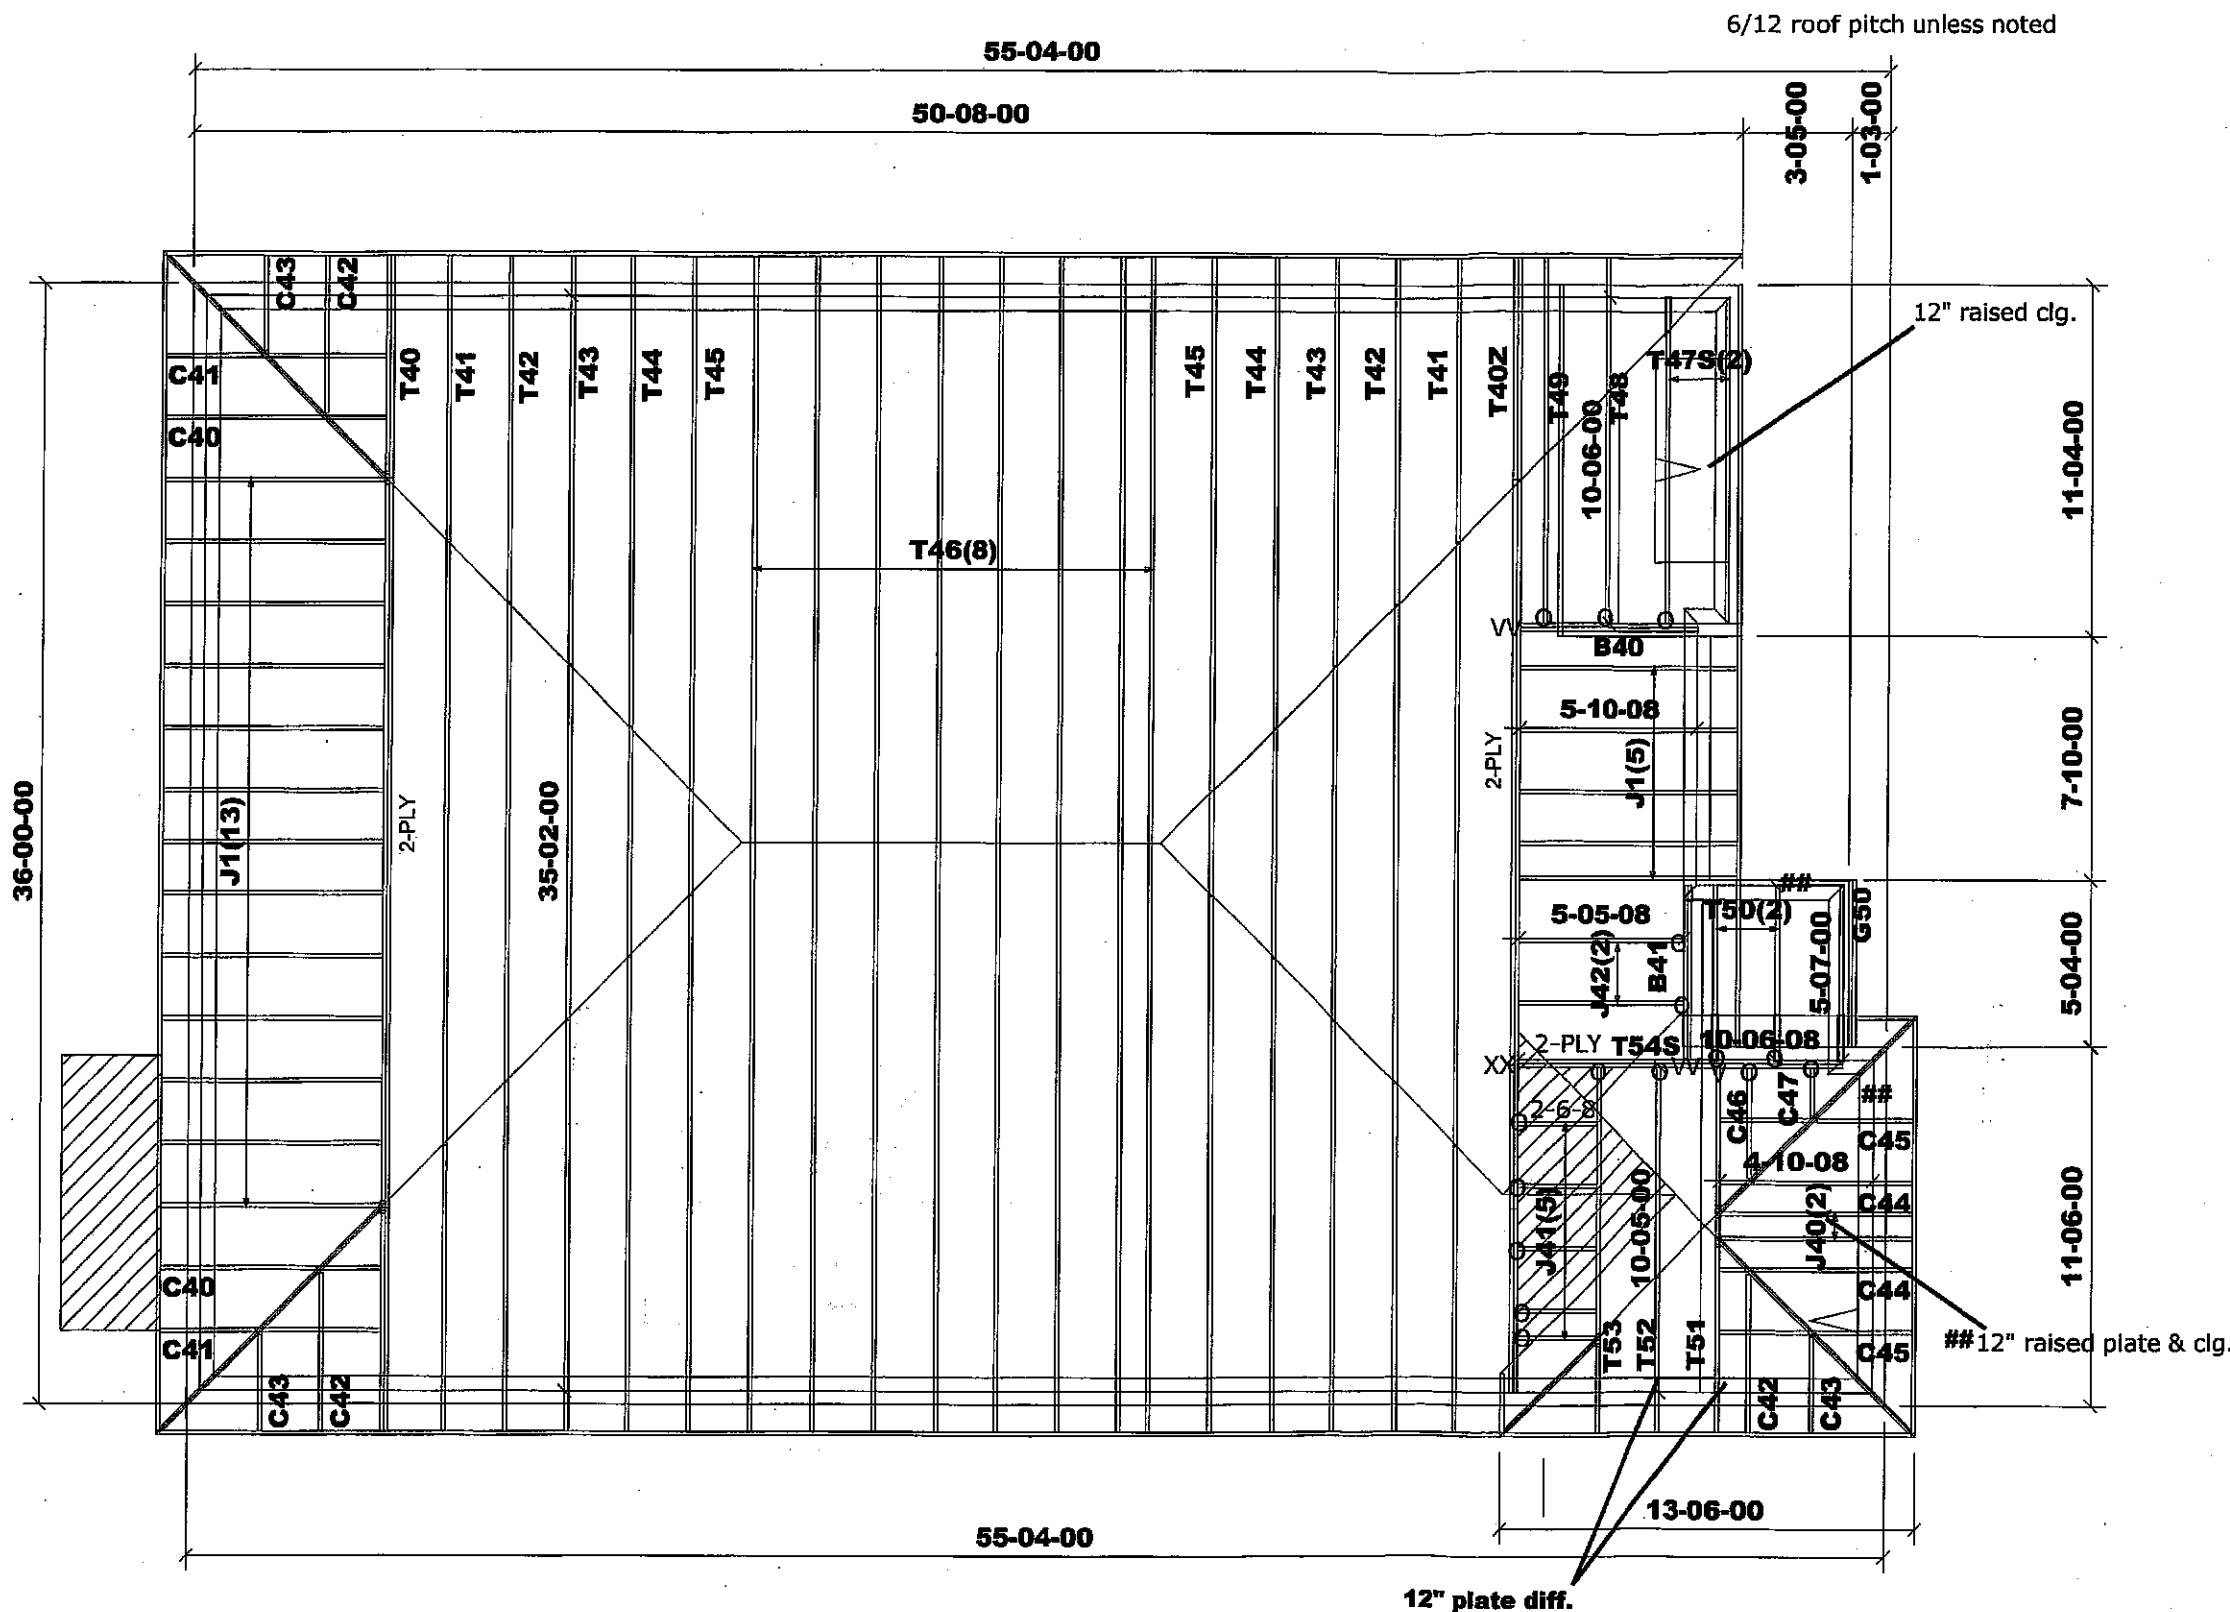

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.


All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
LUS26-2-(VV)

BEAMS:
B40= B41 =
2 - 2x10 SPF #2

 **DENOTES:**
CONVENTIONAL
FRAMING

CITY OF HAMILTON
Building Division
Permit No. 21-107143
SE STAMPED DRAWINGS SHALL BE AVAILABLE ON THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE. These drawings and/or specifications have been reviewed: FEB 26 2021
FOR CHIEF BUILDING OFFICIAL DATE

M13138



Job Track: 51225	Builder / Location: GREEN PARK HOMES / WATERDOWN	Model / Elevation: MOUNTAINASH 6/3- STD OR OPT.5 BR	File ver 8.3.1.215
Plan Log: 202419	Project: RUSSELL GARDENS PH.3	THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.	
Layout ID: 408224	Date: 2020-04-27	Sales: Mario DiCano	Designer: JG

LOT 263








 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 6 Lot #: 263 Elevation: 3- STD OR OPT.5 BR	Job Track: 51225 PlanLog: 202419 Layout ID: 408224 Ref # Page: 1 of 3 Date: 04-27-2020 Designer: Sales Rep: Mario DiCano


Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T40 Hip Girder	6 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	337.56 208.00		
	1 2-ply	T40Z Hip Girder	6 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	337.56 208.00		
	2	T41 Hip	6 /12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.99 174.00		
	2	T42 Hip	6 /12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.12 174.67		
	2	T43 Hip	6 /12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	289.07 179.67		
	2	T44 Hip	6 /12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	290.73 183.33		
	2	T45 Hip	6 /12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	301.67 191.33		
	8	T46 Common	6 /12	35-02-00	9-11-08	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1178.98 725.33		
	2	T47S Roof Special	0 /12	10-06-00	3-06-00	2 x 4		3-06-00 3-06-00	101.09 63.87		
	1	T48 Half Hip	6 /12	10-06-00	2-08-00	2 x 4	1-03-08	1-02-00 2-08-00	39.94 26.67		
	1	T49 Half Hip	6 /12	10-06-00	3-08-00	2 x 4	1-03-08	1-02-00 3-08-00	41.91 27.50		
	2	T50 Flat	0 /12	5-07-00	3-00-00	2 x 4		3-00-00 3-00-00	45.54 30.00		
	1	G50 GABLE	0 /12	5-07-00	3-00-00	2 x 4		3-00-00 3-00-00	22.18 15.00		
	1	T51 Hip Girder	6 /12	10-05-00	3-07-04	2 x 4	1-03-08	1-02-00 1-03-08	43.52 29.67		

 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST				Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 6 Lot #: 263 Elevation: 3- STD OR OPT.5 BR		Job Track: 51225 PlanLog: 202419 Layout ID: 408224 Ref #: Page: 2 of 3 Date: 04-27-2020 Designer: Sales Rep: Mario DiCano	

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T52 Hip	6 /12	10-05-00	4-00-00	2 x 4	1-03-08	2-02-00 2-03-08	45.94 29.83		
	1	T53 Hip Girder	6 /12	10-05-00	3-00-00	2 x 4	1-03-08	2-02-00 2-03-08	46.32 31.83		
	1 2-ply	T54S Roof Special Girder	0 /12	10-06-08	2-02-00	2 x 4 2 x 6		1-02-00 2-02-00	97.7 64.33		
	18	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	302.3 192.00		
	2	J40 Jack-Open	6 /12	4-10-08	3-07-04	2 x 4	1-03-08	1-02-00 3-07-04	28.76 18.67		
	5	J41 Jack-Open	6 /12	2-06-08	3-00-00	2 x 4		1-08-12 3-00-00	49.19 34.17		
	2	J42 Jack-Open	6 /12	5-05-08	4-01-04	2 x 4		1-04-08 4-01-04	31.44 20.67		
	2	C40 Jack-Open	6 /12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	28.26 17.33		
	2	C41 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	23.16 14.67		
	3	C42 Jack-Open	6 /12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	28.71 18.00		
	3	C43 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	21.08 14.00		
	2	C44 Jack-Open	6 /12	3-09-07	3-00-12	2 x 4	1-03-08 1-01-01	1-02-00 3-00-12	25.98 16.00		
	2	C45 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 3-01-01	1-02-00 2-00-12	20.88 13.33		
	1	C46 Jack-Open	6 /12	1-07-08	3-00-12	2 x 4	1-10-15	1-03-08 2-01-04	7.46 5.33		

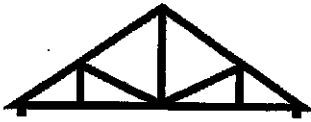 TAMARACK ROOF TRUSSES INC. ALFA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 6 Lot #: 263 Elevation: 3- STD OR OPT.5 BR	Job Track: 51225 PlanLog: 202419 Layout ID: 408224 Ref # Page: 3 of 3 Date: 04-27-2020 Designer: Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	C47 Jack-Open	6 /12	1-07-08	2-00-12	2 x 4		1-03-08 2-01-04	4.91 3.33		

TOTAL # TRUSS= 77

TOTAL BFT OF ALL TRUSSES= 2730.33

BFT.

TOTAL WEIGHT OF ALL TRSSES 4346.93 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS26-2	
1	Hardware	LJS26DS	
14	Hardware	LUS24	
2	Hardware	LUS26-2	

TOTAL NUMBER OF
ITEMS=


18

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T1	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 28 2019 MTek Industries, Inc. Tue Apr 28 09:00:04 2020 Page 1
ID:DMCubINVR6TsiFoe31v6l zns11-Jm9J91AhZ122g2EEemNZsEz3HTHimEdCAUuvczMFI

1-3-8 0-0 4-0-10 4-0-10 5-3-2 9-3-12 5-5-12 14-9-8 2-9-8 17-7-0 20-4-8 5-8-12 5-3-2 31-1-6 4-0-10 35-2-0 1-3-8
Scale = 1:57.6

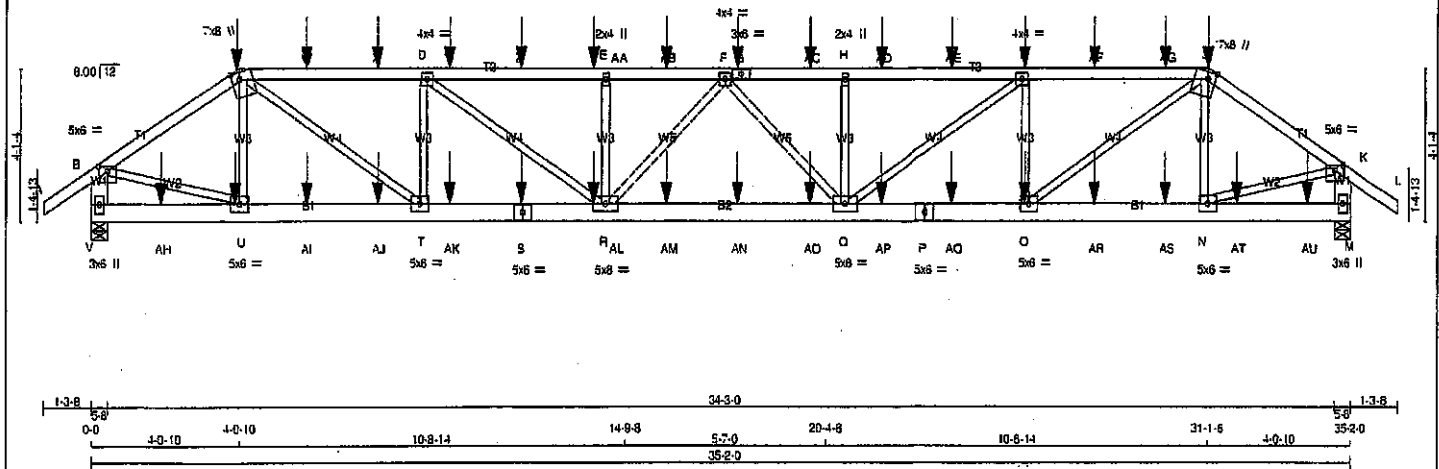

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - G	2x4	DRY	No.2	SPF	
G - J	2x4	DRY	No.2	SPF	
J - L	2x4	DRY	No.2	SPF	
V - B	2x6	DRY	No.2	SPF	
M - K	2x6	DRY	No.2	SPF	
V - S	2x6	DRY	No.2	SPF	
S - P	2x6	DRY	No.2	SPF	
P - M	2x6	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE(61.0)
C - G	12	SIDE(61.0)
G - J	12	SIDE(61.0)
J - L	12	SIDE(61.0)
V - B	2	TOP
M - K	2	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
V - S	2	SIDE(163.1)
S - P	2	SIDE(163.1)
P - M	2	SIDE(163.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-9 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PILES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT 3393	DOWN 3393	0	5-8
M	HORIZ 3342	UPLIFT 3342	0	5-8

UNFACTORED REACTIONS	1ST LCASE	MAX-MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
V	2397	1585 0 0 0 0 0 0 812 0 0 0
M	2363	1555 0 0 0 0 0 0 808 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.11 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED MEMB. FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO		
A-B	0 35	-91.8 -91.8 0.07 (1)	10.00	U-C	-620 0	0.08 (1)
B-C	-4024 0	-91.8 -91.8 0.22 (1)	4.55	C-T	0 3389	0.42 (1)
C-W	-6074 0	-91.8 -91.8 0.53 (1)	3.51	T-D	-1846 0	0.23 (1)
W-X	-6074 0	-91.8 -91.8 0.53 (1)	3.51	O-I	-1869 0	0.24 (1)
X-D	-6074 0	-91.8 -91.8 0.53 (1)	3.51	Q-J	0 3425	0.42 (1)
D-Y	-7423 0	-91.8 -91.8 0.63 (1)	3.11	N-U	-601 0	0.08 (1)
Y-Z	-7423 0	-91.8 -91.8 0.63 (1)	3.11	B-U	0 3437	0.43 (1)
Z-AA	-7423 0	-91.8 -91.8 0.63 (1)	3.11	N-K	0 3371	0.42 (1)
AA-E	-7423 0	-91.8 -91.8 0.63 (1)	3.11	Q-I	0 1704	0.21 (1)
E-AB	-7423 0	-91.8 -91.8 0.35 (1)	3.36	D-R	0 1677	0.21 (1)
AB-F	-7423 0	-91.8 -91.8 0.35 (1)	3.36	Q-H	-595 0	0.08 (1)
F-G	-7410 0	-91.8 -91.8 0.36 (1)	3.36	R-E	-594 0	0.08 (1)
G-AC	-7410 0	-91.8 -91.8 0.36 (1)	3.36	R-F	-285 0	0.06 (1)
AC-H	-7410 0	-91.8 -91.8 0.36 (1)	3.36	F-D	-305 0	0.06 (1)
H-AD	-7410 0	-91.8 -91.8 0.61 (1)	3.14			
AD-AE	-7410 0	-91.8 -91.8 0.61 (1)	3.14			
AE-I	-7410 0	-91.8 -91.8 0.61 (1)	3.14			
I-AF	-6040 0	-91.8 -91.8 0.51 (1)	3.65			
AF-AG	-6040 0	-91.8 -91.8 0.51 (1)	3.65			
AG-J	-6040 0	-91.8 -91.8 0.51 (1)	3.65			
J-K	-3946 0	-91.8 -91.8 0.22 (1)	4.58			
K-L	0 35	-91.8 -91.8 0.07 (1)	10.00			
V-B	-3355 0	0.0 0.0 0.12 (1)	7.60			
M-K	-3296 0	0.0 0.0 0.12 (1)	7.64			

V-AH	0 0	-18.5 -18.5 0.04 (4)	10.00
AH-U	0 0	-18.5 -18.5 0.04 (4)	10.00
U-AI	0 3325	-18.5 -18.5 0.25 (1)	10.00
AI-AJ	0 3325	-18.5 -18.5 0.25 (1)	10.00
AJ-T	0 3325	-18.5 -18.5 0.25 (1)	10.00
T-AK	0 6074	-18.5 -18.5 0.45 (1)	10.00
AK-S	0 6074	-18.5 -18.5 0.45 (1)	10.00
S-AL	0 6074	-18.5 -18.5 0.45 (1)	10.00
AL-R	0 6074	-18.5 -18.5 0.45 (1)	10.00
R-AM	0 7613	-18.5 -18.5 0.57 (1)	10.00
AM-AN	0 7613	-18.5 -18.5 0.57 (1)	10.00
AN-AO	0 7613	-18.5 -18.5 0.57 (1)	10.00
AO-Q	0 7613	-18.5 -18.5 0.57 (1)	10.00
Q-AP	0 6040	-18.5 -18.5 0.45 (1)	10.00
AP-P	0 6040	-18.5 -18.5 0.45 (1)	10.00
P-AQ	0 6040	-18.5 -18.5 0.45 (1)	10.00
AQ-O	0 6040	-18.5 -18.5 0.45 (1)	10.00
O-AR	0 3261	-18.5 -18.5 0.25 (1)	10.00

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.23")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/970 (0.44")

CSI: TC=0.63/1.00 (D-E:1), BC=0.57/1.00 (Q-R:1),

WB=0.43/1.00 (B-U:1), SSI=0.19/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.86 (I) INPUT = 0.90 ;
JSI METAL=0.58 (I) INPUT = 1.00 ;



Structural component only
DWG# T-2007602 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T1	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:00:04 2020 Page 2
ID:DMCubINVR6TsIFoe31v6I zns1H-Jm9J91AhZl22a2EEmlNZsEz3HTH7mEdCAUuvczMFI

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	6.0	1.50	3.00
C	TTWW+m	MT20	7.0	8.0	Edge	2.50
D, F, I						
D	TMWW-I	MT20	4.0	4.0		
E	TMW+w	MT20	2.0	4.0		
G	TS-I	MT20	3.0	6.0		
H	TMW+w	MT20	2.0	4.0		
J	TTWW+m	MT20	7.0	8.0	Edge	2.50
K	TMWV-p	MT20	5.0	6.0	1.50	3.00
M	BMV1+p	MT20	3.0	6.0		
N, O, T, U						
N	BMWV-I	MT20	5.0	6.0		
P	BS-I	MT20	5.0	6.0		
Q	BMWVW-I	MT20	5.0	8.0		
R	BMWVW-I	MT20	5.0	8.0		
S	BS-I	MT20	5.0	6.0		
V	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. MEMB. FORCE (LBS)	MAX. FACTORED UNBRAC. LENGTH	FR-TO	
FR-TO		FROM	TO				
AR-AS	0 3261	-18.5	-18.5	0.25 (1)	10.00		
AS-N	0 3261	-18.5	-18.5	0.25 (1)	10.00		
N-AT	0 0	-18.5	-18.5	0.04 (4)	10.00		
AT-AU	0 0	-18.5	-18.5	0.04 (4)	10.00		
AU-M	0 0	-18.5	-18.5	0.04 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-10	-48	-55	---	FRONT	VERT	DEAD	---	C1
C	4-0-10	-117	-117	---	FRONT	VERT	TOTAL	---	C1
C	4-0-10	-254	-254	---	FRONT	VERT	SNOW	---	C1
G	17-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
I	25-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
J	31-1-8	-49	-55	---	FRONT	VERT	DEAD	---	C1
J	31-1-8	-254	-254	---	FRONT	VERT	SNOW	---	C1
O	25-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
S	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
U	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
W	5-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	19-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	21-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	23-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	27-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AG	29-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AH	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AL	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AM	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AN	17-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	19-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AP	21-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AQ	23-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AR	27-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AS	29-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AT	31-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AU	33-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007602 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T1Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:00:05 2020 Page 1
 ID:DMCubINVR6TstFoe31v6t zns1l-nyjhmNBKJcAvHCpQkTuoORWDoscNkApnRqDRR2zMFie
 1-3-8 0-0 4-0-10 5-3-4 7-3-4 9-3-12 5-5-12 14-9-8 2-9-8 17-7-0 2-9-8 20-4-8 3-5-12 25-10-4 5-3-2 31-1-8 4-0-10 35-2-0 1-3-8
 Scale = 1:57.6

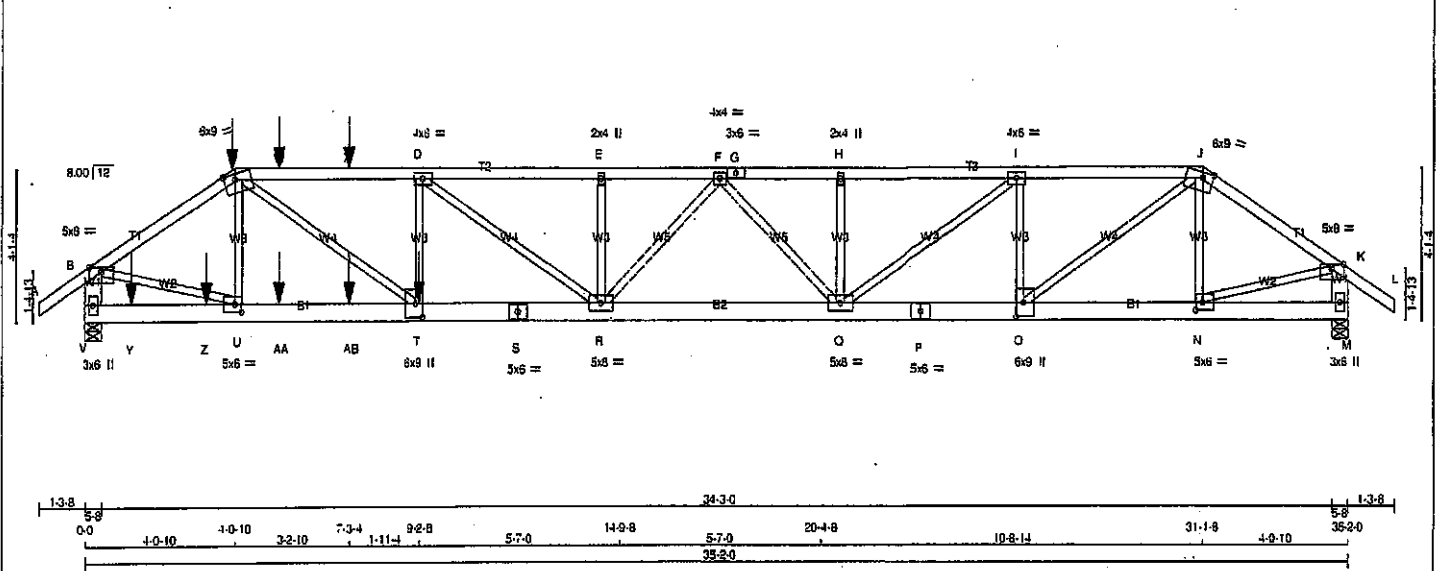

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - G	2x4	DRY	No.2	SPF	
G - J	2x4	DRY	No.2	SPF	
J - L	2x4	DRY	No.2	SPF	
V - B	2x6	DRY	No.2	SPF	
M - K	2x6	DRY	No.2	SPF	
V - S	2x6	DRY	No.2	SPF	
S - P	2x6	DRY	No.2	SPF	
P - M	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : 10.122"x3" SPIRAL NAILS		
A-C	12	SIDE(81.0)
C-G	12	SIDE(81.0)
G-J	12	TOP
J-L	12	TOP
V-B	12	TOP
M-K	12	TOP
BOTTOM CHORDS : 10.122"x3" SPIRAL NAILS		
V-S	12	SIDE(183.1)
S-P	12	TOP
P-M	12	TOP
WEBS : 10.122"x3" SPIRAL NAILS		
2x3	6	SIDE(385.4)
D-T	4	
I-O	4	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORIZ	DOWN	HORIZ
V	4215	0	4215	0
M	2722	0	2722	0

UNFACTORED REACTIONS	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
V	2974	1987	0	0	0	0
M	1921	1263	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.00 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			WEBS				
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX CSH (LC)	MAX. UNBRACED LENGTH	MEMB.	FORCE (LBS)	MAX CSH (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 35	-91.8 -91.8 0.07 (1)	10.00	U-C	-783 0	0.10 (1)	
B-C	-5115 0	-91.8 -91.8 0.28 (1)	4.07	C-T	0 4817	0.80 (1)	
C-W	-8135 0	-91.8 -91.8 0.64 (1)	3.00	T-D	-622 0	0.08 (1)	
W-X	-8135 0	-91.8 -91.8 0.64 (1)	3.00	O-I	-1797 0	0.23 (1)	
X-D	-8135 0	-91.8 -91.8 0.64 (1)	3.00	Q-J	0 3211	0.40 (1)	
D-E	-8108 0	-91.8 -91.8 0.59 (1)	3.05	N-J	-512 0	0.06 (1)	
E-F	-8108 0	-91.8 -91.8 0.32 (1)	3.28	B-U	0 4370	0.54 (1)	
F-G	-8928 0	-91.8 -91.8 0.28 (1)	3.57	N-K	0 2693	0.33 (1)	
G-H	-8928 0	-91.8 -91.8 0.28 (1)	3.57	Q-I	0 2133	0.26 (1)	
H-I	-8928 0	-91.8 -91.8 0.45 (1)	3.42	D-R	-37 24	0.01 (1)	
I-J	-5210 0	-91.8 -91.8 0.34 (1)	3.99	Q-H	-365 0	0.05 (1)	
J-K	-3153 0	-91.8 -91.8 0.19 (1)	5.04	R-E	-343 0	0.04 (1)	
K-L	0 35	-91.8 -91.8 0.07 (1)	10.00	R-F	0 692	0.09 (1)	
V-B	-4180 0	0.0 0.0 0.15 (1)	8.99	F-Q	-1081 0	0.23 (1)	
M-X	-2698 0	0.0 0.0 0.10 (1)	7.81				
V-Y	0 0	-18.5 -18.5 0.05 (4)	10.00				
Y-Z	0 0	-18.5 -18.5 0.05 (4)	10.00				
Z-U	0 0	-18.5 -18.5 0.05 (4)	10.00				
U-AA	0 4227	-18.5 -18.5 0.35 (1)	10.00				
AA-AB	0 4227	-18.5 -18.5 0.35 (1)	10.00				
AB-T	0 4227	-18.5 -18.5 0.35 (1)	10.00				
T-S	0 8135	-18.5 -18.5 0.61 (1)	10.00				
S-R	0 8135	-18.5 -18.5 0.61 (1)	10.00				
R-Q	0 7845	-18.5 -18.5 0.55 (1)	10.00				
Q-P	0 5210	-18.5 -18.5 0.38 (1)	10.00				
P-O	0 5210	-18.5 -18.5 0.38 (1)	10.00				
O-N	0 2604	-18.5 -18.5 0.19 (1)	10.00				
N-M	0 0	-18.5 -18.5 0.03 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
JT	4-0-10	-49	-55	---	---	FRONT	VERT	DEAD	---	C1
C	4-0-10	-254	-254	---	---	FRONT	VERT	SNOW	---	C1
T	9-2-8	-2179	-2179	---	---	BACK	VERT	TOTAL	---	C1
W	5-3-4	-110	-110	---	---	BACK	VERT	TOTAL	---	C1
X	7-3-4	-110	-110	---	---	BACK	VERT	TOTAL	---	C1
Y	1-3-4	-26	-26	---	---	BACK	VERT	TOTAL	---	C1
Z	3-3-4	-26	-26	---	---	BACK	VERT	TOTAL	---	C1
AA	5-3-4	-26	-26	---	---	BACK	VERT	TOTAL	---	C1
AB	7-3-4	-26	-26	---	---	BACK	VERT	TOTAL	---	C1

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
 GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
 LOADS WERE DERIVED FROM USER INPUT
 NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 5.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
 ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/998 (0.24")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/954 (0.44")

CSI: TC=0.64/1.00 (C-D:1), BC=0.61/1.00 (R-T:1), WB=0.60/1.00 (G-T:1), SS=0.17/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (J) INPUT = 0.99
 JSI METAL= 0.77 (P) INPUT = 1.00



Structural component only
 DWG# T-2007603 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T1Z	1	2	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:05 2020 Page 2
ID:DMCubINVR6TstFae31v6l zns1l-nvjhMNBjKcAvHCpQKTuoQRWDoscNkApnRqDRR2zMFle


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW-m	MT20	6.0	9.0	1.75	3.50
D	TMVW-t	MT20	4.0	6.0		
E	TMVW-w	MT20	2.0	4.0		
F	TMVW-t	MT20	4.0	4.0		
G	TS-t	MT20	3.0	6.0		
H	TMVW-w	MT20	2.0	4.0		
I	TMVW-t	MT20	4.0	6.0		
J	TTWW-m	MT20	6.0	9.0	1.75	3.50
K	TMVW-p	MT20	5.0	8.0	Edge	
M	BMV1+p	MT20	3.0	6.0		
N	BMVW-t	MT20	5.0	6.0	2.50	2.25
O	BMVW-t	MT20	6.0	9.0	4.50	2.50
P	BS-t	MT20	5.0	6.0		
Q	BMVWW-t	MT20	5.0	8.0		
R	BMVWW-t	MT20	5.0	8.0		
S	BS-t	MT20	5.0	6.0		
T	BMVW-t	MT20	6.0	9.0	4.50	2.50
U	BMVW-t	MT20	5.0	6.0	2.50	2.25
V	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

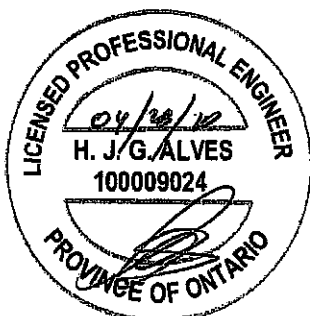

Structural component only
DWG# T-2007603 *4/2*


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T2	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Tue Apr 28 09:00:06 2020 Page 1

ID:DMCubINVR8TsIfos31v6l zns11-F8H4ajCx5wlmwMOcuAP1x2LGGy5TgYwUz? UzMFid

1-3-8 0-0 5-8-10 5-8-10 6-0-13 11-7-7 5-11-9 17-7-0 5-11-9 23-6-9 6-0-13 29-7-6 5-8-10 35-2-0 1-3-8 Scale = 1:57.6

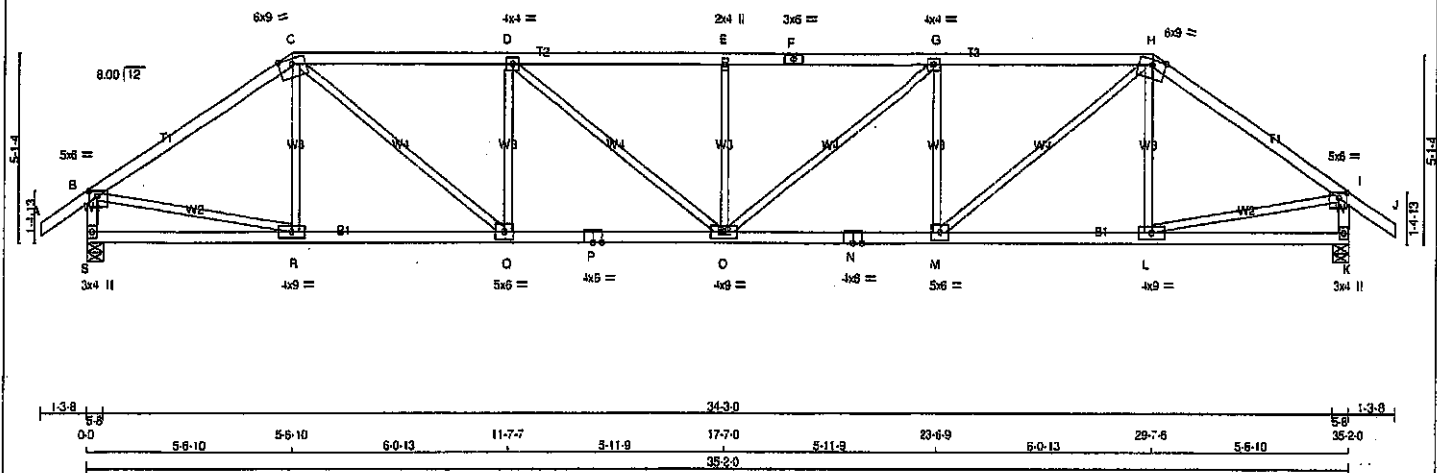

TOTAL WEIGHT = 2 X 140 = 280 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
J - L	2x4	DRY	No.2	SPF	
L - P	2x4	DRY	No.2	SPF	
P - N	2x4	DRY	No.2	SPF	
N - K	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table in inches)	W	LEN	Y	X
JT TYPE PLATES				
B TMVW-p	MT20	5.0	8.0	1.75 2.75
C TTWW-m	MT20	6.0	9.0	Edge
D TMVW-l	MT20	4.0	4.0	
E TMVW-w	MT20	2.0	4.0	
F TS-l	MT20	3.0	6.0	
G TMVW-l	MT20	4.0	4.0	
H TTWW-m	MT20	6.0	9.0	Edge
I TMVW-p	MT20	5.0	8.0	1.75 2.75
K BMV1-p	MT20	3.0	4.0	
L BMVW-l	MT20	4.0	9.0	
M BMVW-l	MT20	5.0	5.0	
N SS-l	MT20	4.0	5.0	
O BMVW-l	MT20	4.0	9.0	
P SS-l	MT20	4.0	6.0	
Q BMVW-l	MT20	5.0	6.0	
R BMVW-l	MT20	4.0	9.0	
S BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	2065	2065	0	5-8
S	2065	2065	0	5-8
K	2065	2065	0	5-8

UNFACTORED REACTIONS

	1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
JT COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
S	1458	970.0	0.0	0.0	0.0	488	0
K	1458	970.0	0.0	0.0	0.0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.97 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED HORIZ. LOAD (LC)	WEBS	MEMB.	FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LC)
FR-TO			FROM	TO	LENGTH	FR-TO			
A-B	0	35	-91.8	-91.8	0.12 (1)	10.00	R-C	-243	10
B-C	-2295	0	-91.8	-91.8	0.70 (1)	3.78	C-Q	0	1670
C-D	-3213	0	-91.8	-91.8	0.80 (1)	3.19	Q-D	-929	0
D-E	-3594	0	-91.8	-91.8	0.86 (1)	2.97	D-O	0	490
E-F	-3594	0	-91.8	-91.8	0.88 (1)	2.97	O-E	-505	0
F-G	-3594	0	-91.8	-91.8	0.86 (1)	2.97	O-G	0	490
G-H	-3213	0	-91.8	-91.8	0.80 (1)	3.19	M-H	-929	0
H-I	-2295	0	-91.8	-91.8	0.70 (1)	3.78	M-H	0	1670
I-J	0	35	-91.8	-91.8	0.12 (1)	10.00	L-H	-243	10
J-B	-2023	0	0.0	0.0	0.21 (1)	5.94	B-R	0	1943
K-I	-2023	0	0.0	0.0	0.21 (1)	5.94	L-I	0	1943
S-R	0	0	-18.5	-18.5	0.15 (4)	10.00			
R-Q	0	1903	-18.5	-18.5	0.39 (1)	10.00			
Q-P	0	3213	-18.5	-18.5	0.56 (1)	10.00			
P-O	0	3213	-18.5	-18.5	0.56 (1)	10.00			
O-N	0	3213	-18.5	-18.5	0.56 (1)	10.00			
N-M	0	3213	-18.5	-18.5	0.56 (1)	10.00			
M-L	0	1903	-18.5	-18.5	0.39 (1)	10.00			
L-K	0	0	-18.5	-18.5	0.15 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 08-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.38")

CS: TC=0.86/1.00 (D-E:1), BC=0.59/1.00 (M-O:1),
WB=0.44/1.00 (I-L:1), SS=0.26/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.87 (I) (INPUT = 0.90)
JSI METAL = 0.74 (I) (INPUT = 1.00)



Structural component only
DWG# T-2007604

JOB NAME 408222	TRUSS NAME T3	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 26 09:00:06 2020 Page 1
 ID:DMCubINVR6TstFoa31v61_zns11-F8H4aCk5wimvMOcuAP1xf2QrG_VTXHwUz?_UzmFId
 Scale = 1:57.6

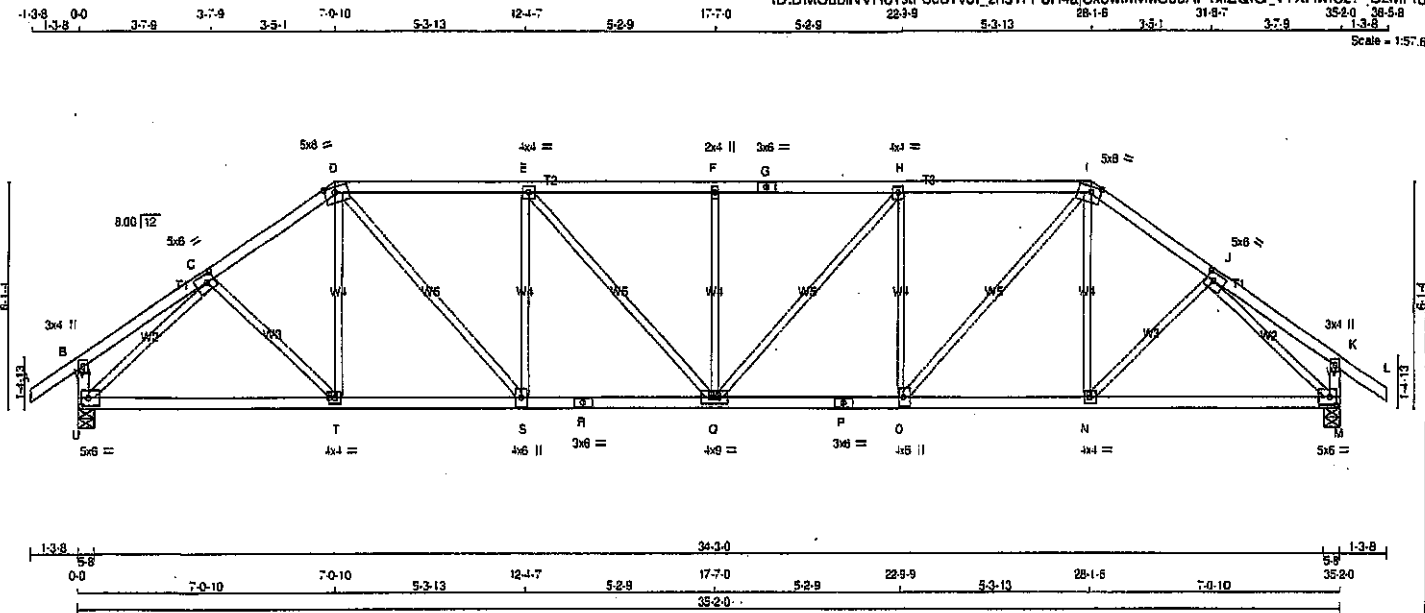

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER								DESIGN CRITERIA					
N. L. G. A. RULES				BEARINGS								SPECIFIED LOADS:					
CHORDS	SIZE	LUMBER	DESCR.	GROSS REACTION		GROSS REACTION		INPUT		REQD		TOP CH.	LL	DL	PSF		
A - D	2x4	DRY	No.2	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX							
D - G	2x4	DRY	No.2	JT													
G - I	2x4	DRY	No.2	U													
I - L	2x4	DRY	No.2	M													
U - B	2x4	DRY	No.2														
M - K	2x4	DRY	No.2														
U - R	2x4	DRY	No.2														
R - P	2x4	DRY	No.2														
P - M	2x4	DRY	No.2														
ALL WEBS EXCEPT				UNFACTORED REACTIONS				SPACING = 24.0 IN. C/C									
				1ST LCASE				MAX. MIN. COMPONENT REACTIONS				LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12					
				COMBINED		SNOW		LIVE		PERM.LIVE		WIND		DEAD		SOIL	
				JT		U		M									
				1458		970.0		0.0		0.0		0.0		468.0		0.0	
				U		1458		970.0		0.0		0.0		468.0		0.0	

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV-p	MT20	3.0	4.0	
C	TMVW-t	MT20	5.0	6.0	2.50 2.50
D	TTWV-m	MT20	5.0	8.0	1.75 3.50
E	TMVW-t	MT20	4.0	4.0	
F	TMVW-w	MT20	2.0	4.0	
G	TS-t	MT20	3.0	6.0	
H	TMVW-t	MT20	4.0	4.0	
I	TTWV-m	MT20	5.0	8.0	1.75 3.50
J	TMVW-t	MT20	5.0	6.0	2.50 2.50
K	TMV-p	MT20	3.0	4.0	
M	BMVW-t	MT20	5.0	6.0	2.50 2.25
N	BMVW-t	MT20	4.0	4.0	
O	BMVW-t	MT20	4.0	6.0	
P	BS-t	MT20	3.0	6.0	
Q	BMVW-t	MT20	4.0	9.0	
R	BS-t	MT20	3.0	6.0	
S	BMVW-t	MT20	4.0	6.0	
T	BMVW-t	MT20	4.0	4.0	
U	BMVW-t	MT20	5.0	6.0	2.50 2.25

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED VERT. LOAD LC1	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1	MAX. UNBRAC LENGTH	
FR-TO		FROM	TO		FR-TO				
A-B	0 35	-91.8	-91.8	0.12 (1)	10.00	C-T	0 135	0.03 (4)	
B-C	0 18	-91.8	-91.8	0.16 (1)	10.00	T-D	0 90	0.03 (4)	
C-D	-2305 0	-91.8	-91.8	0.23 (1)	4.31	D-S	0 1218	0.27 (1)	
D-E	-2723 0	-91.8	-91.8	0.54 (1)	3.69	S-E	-814 0	0.48 (1)	
E-F	-2966 0	-91.8	-91.8	0.56 (1)	3.53	E-Q	0 363	0.08 (1)	
F-G	-2966 0	-91.8	-91.8	0.58 (1)	3.53	Q-F	-440 0	0.26 (1)	
G-H	-2966 0	-91.8	-91.8	0.58 (1)	3.53	Q-H	0 363	0.08 (1)	
H-I	-2723 0	-91.8	-91.8	0.54 (1)	3.69	O-H	-814 0	0.48 (1)	
I-J	-2305 0	-91.8	-91.8	0.23 (1)	4.31	O-I	0 1218	0.27 (1)	
J-K	0 18	-91.8	-91.8	0.16 (1)	10.00	N-I	0 90	0.03 (4)	
K-L	0 35	-91.8	-91.8	0.12 (1)	10.00	N-J	0 135	0.03 (4)	
U-B	-255 0	0.0	0.0	0.03 (1)	7.81	U-C	-2514 0	0.97 (1)	
M-K	-255 0	0.0	0.0	0.03 (1)	7.81	J-M	-2514 0	0.97 (1)	
U-T	0 1801	-18.5	-18.5	0.40 (1)	10.00				
T-S	0 1900	-18.5	-18.5	0.41 (1)	10.00				
S-R	0 2723	-18.5	-18.5	0.49 (1)	10.00				
R-Q	0 2723	-18.5	-18.5	0.49 (1)	10.00				
Q-P	0 2723	-18.5	-18.5	0.49 (1)	10.00				
P-O	0 2723	-18.5	-18.5	0.49 (1)	10.00				
O-N	0 1800	-18.5	-18.5	0.41 (1)	10.00				
N-M	0 1801	-18.5	-18.5	0.40 (1)	10.00				


ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.16")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.29")
 CST: TC=0.56/1.00 (E-F:1), BC=0.49/1.00 (Q-C:1),
 WB=0.97/1.00 (J-M:1), SS=0.23/1.00 (D-E:1)
 DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10
 COMPANION LIVE LOAD FACTOR = 1.00
 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
 NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1656
 PLATE PLACEMENT TOL. = 0.250 inches
 PLATE ROTATION TOL. = 5.0 Deg.
 JSI GRIP = 0.90 (M) (INPUT = 0.90)
 JSI METAL = 0.84 (P) (INPUT = 1.00)



Structural component only
 DWG# T-2007605

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T4	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:00:07 2020 Page 1
ID:DMCubiNVR6TslFoe31v6l_zns1i-lLsN2CZsDQdXWzqSuwGTsbZlgK2C5T4u8YVwzMFic

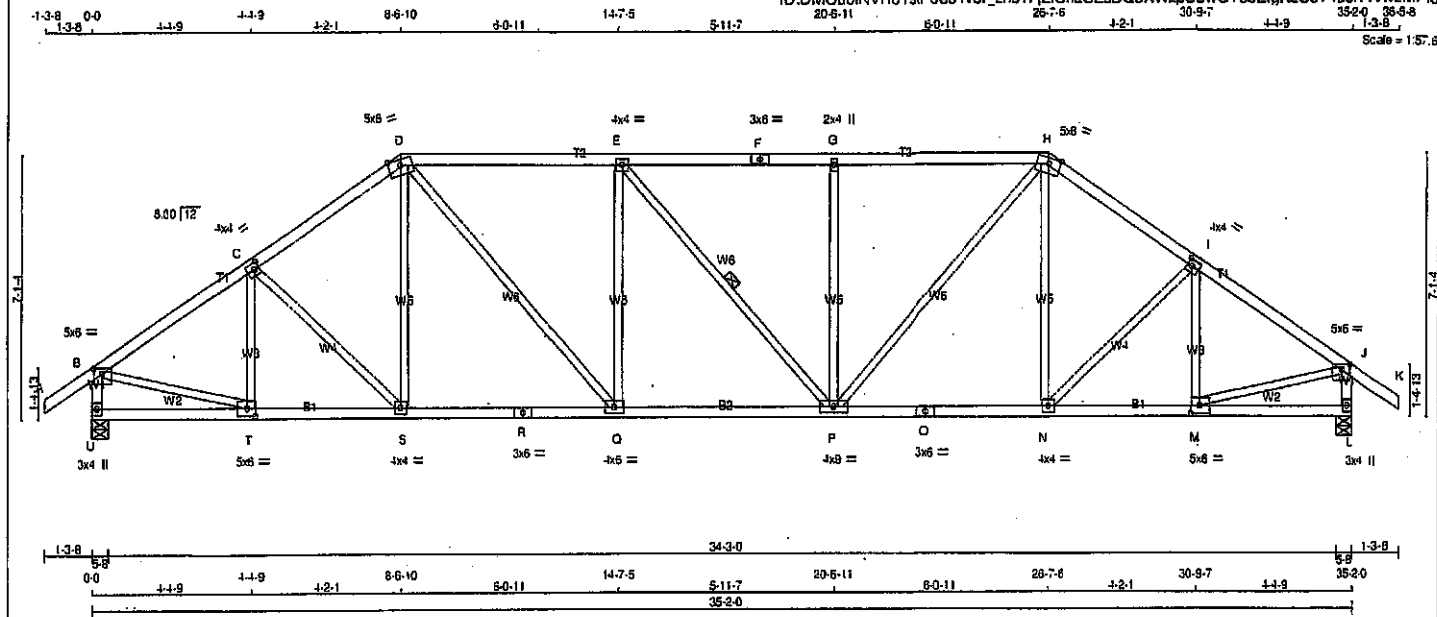

TOTAL WEIGHT = 2 X 155 = 309 lb

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS			
A - D	2x4	DRY	No.2
E - F	2x4	DRY	No.2
G - H	2x4	DRY	No.2
I - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMVW-p	MT20	5.0	6.0	1.75 2.75
C TMVW-i	MT20	4.0	4.0	2.00 1.50
D TTWW-m	MT20	5.0	8.0	Edge
E TMVW-i	MT20	4.0	4.0	
F TS-i	MT20	3.0	6.0	
G TMVW-w	MT20	2.0	4.0	
H TTWW-m	MT20	5.0	8.0	Edge
I TMVW-i	MT20	4.0	4.0	2.00 1.50
J TMVW-p	MT20	5.0	6.0	1.75 2.75
L BMV1-p	MT20	3.0	4.0	
M BMVW-i	MT20	5.0	6.0	2.50 2.75
N BMVW-i	MT20	4.0	4.0	
O BS-i	MT20	3.0	6.0	
P BMVW-w	MT20	4.0	9.0	
Q BMVW-i	MT20	4.0	6.0	
R BS-i	MT20	3.0	6.0	
S BMVW-i	MT20	4.0	4.0	
T BMVW-i	MT20	5.0	6.0	2.50 2.75
U BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
	FACTORED	MAXIMUM FACTORED	INPUT
	GROSS REACTION	GROSS REACTION	BRG
JT	VERT	DOWN	UPLIFT
U	2065	0	0
L	2065	0	0

UNFACTORED REACTIONS			
	1ST CASE	MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE
U	1458	970	0
L	1458	970	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1-2 LENGTH OF E-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING			
TOTAL LOAD CASES: (4)			
CHORDS			
MEMB.	MAX. FACTORED	FACTORED	WEBS
	FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED
			FORCE (LBS)
FR-TO		FROM TO	LENGTH FR-TO
A-B	0 35	-91.8 -91.8 0.12 (1)	10.00
B-C	-2269 0	-91.8 -91.8 0.37 (1)	4.19
C-D	-2254 0	-91.8 -91.8 0.36 (1)	4.21
D-E	-2485 0	-91.8 -91.8 0.84 (1)	3.72
E-F	-2483 0	-91.8 -91.8 0.84 (1)	3.72
F-G	-2483 0	-91.8 -91.8 0.83 (1)	3.74
G-H	-2483 0	-91.8 -91.8 0.36 (1)	4.21
H-I	-2254 0	-91.8 -91.8 0.37 (1)	4.19
I-J	-2269 0	-91.8 -91.8 0.12 (1)	10.00
J-K	0 35	0.0 0.0 0.21 (1)	5.94
U-B	-2027 0	0.0 0.0 0.21 (1)	5.94
L-J	-2026 0	0.0 0.0 0.21 (1)	5.94
U-T	0 0	-18.5 -18.5 0.08 (4)	10.00
T-S	0 1908	-18.5 -18.5 0.37 (1)	10.00
S-R	0 1853	-18.5 -18.5 0.36 (1)	10.00
R-Q	0 1853	-18.5 -18.5 0.36 (1)	10.00
Q-P	0 2485	-18.5 -18.5 0.47 (1)	10.00
P-O	0 1854	-18.5 -18.5 0.36 (1)	10.00
O-N	0 1854	-18.5 -18.5 0.36 (1)	10.00
N-M	0 1908	-18.5 -18.5 0.37 (1)	10.00
M-L	0 0	-18.5 -18.5 0.08 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.84/1.00 (D-E:1), BC=0.47/1.00 (P-Q:1),
WB=0.52/1.00 (E-Q:1), SS=0.26/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (D) (INPUT = 0.90)
JSI METAL= 0.62 (Q) (INPUT = 1.00)

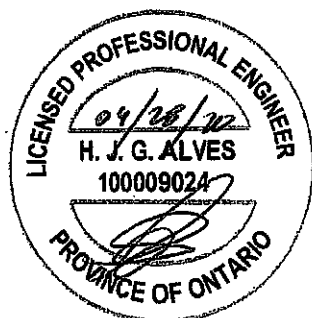

Structural component only
DWG# T-2007606

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T5	2	1	TRUSS DESC.		


Tamareck Roof Truss, Burlington

Version 2.310 5 Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:08 2020 Page 1

ID:DMCubINVR6TsFoe31v6I zns11-BXPq ODBdXYU8Y??bRV048IM4gExZrD76S52NmMFib

1-3-8 0-0 5-1-9 5-1-9 4-11-1 10-0-10 7-6-8 17-7-0 7-6-8 25-1-6 4-11-1 30-0-7 5-1-9 1-3-8 35-2-0 36-5-8

Scale = 1:57.6

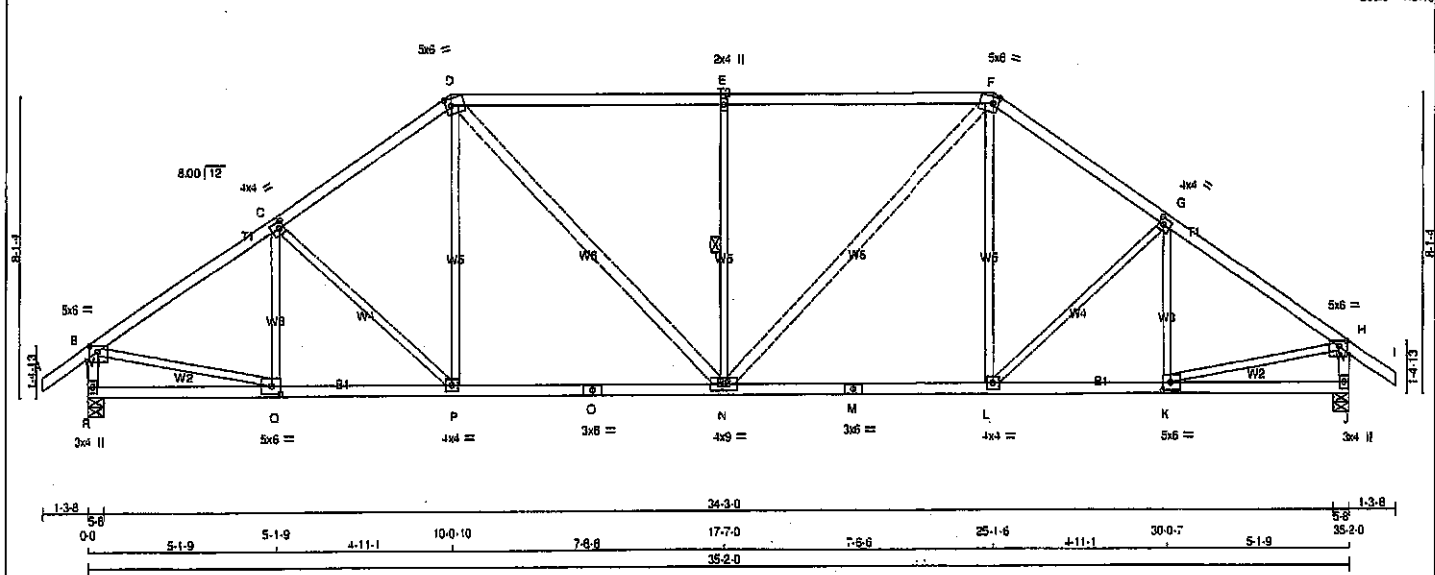

TOTAL WEIGHT = 2 X 158 = 317 lb

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES				
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
I - B	2x4	DRY	No.2	SPF
B - H	2x4	DRY	No.2	SPF
H - O	2x4	DRY	No.2	SPF
O - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
D - N	2x4	DRY	No.2	SPF
N - F	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE				
B TMWV-p	MT20	5.0	6.0	1.75 2.75
C TMWV-t	MT20	4.0	4.0	2.00 1.50
D TTWW-m	MT20	5.0	6.0	2.25 1.75
E TMWV-w	MT20	2.0	4.0	
F TTWW-m	MT20	5.0	6.0	2.25 1.75
G TMWV-l	MT20	4.0	4.0	2.00 1.50
H TMWV-p	MT20	5.0	6.0	1.75 2.75
J BMV1-p	MT20	3.0	4.0	
K BMWV-l	MT20	5.0	6.0	2.50 2.75
L BMWV-l	MT20	4.0	4.0	
M BS-t	MT20	3.0	6.0	
N BMWV-w	MT20	4.0	4.0	
O BS-t	MT20	3.0	6.0	
P BMWV-l	MT20	4.0	4.0	
Q BMWV-l	MT20	5.0	6.0	2.50 2.75
R BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	UPLIFT	IN-SX
R	2085	0	0	5-8
J	2085	0	0	5-8

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
R	1456	970 0 0 0 0 0 0 0 0 0 0
J	1456	970 0 0 0 0 0 0 0 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING	CHORDS	WEBS
TOTAL LOAD CASES: (4)	MAX. FACTORED	MAX. FACTORED
	MEMB. FORCE (LBS)	MEMB. FORCE (LBS)
	VERT. LOAD LC1	MAX. UNBRAC
	FROM TO	LENGTH
	FR-TO	FR-TO
	A-B	0 35
	B-C	-2317 0
	C-D	-2185 0
	D-E	-2274 0
	E-F	-2274 0
	F-G	-2185 0
	G-H	-2317 0
	H-I	0 35
	I-B	-2022 0
	J-H	-2022 0
	R-Q	0 0
	Q-P	0 1953
	P-O	0 1794
	O-N	0 1794
	N-M	0 1794
	M-L	0 1794
	L-K	0 1953
	K-J	0 0

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 085-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSI: TC=0.81:1.00 (E-F:1), SC=0.41:1.00 (L-N:1), WB=0.45:1.00 (H-K:1), SSI=0.34:1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.87 (H) (INPUT = 0.90)
JSI METAL= 0.64 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007607

JOB NAME 408222	TRUSS NAME T6	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 3.310 5 Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:09 2020 Page 1
 ID:DMCubNVR6TstFoe31v6l_zns1l-fjyCCKEpOrgLmp6BZlykZHpxkU0nq01MLS8apzMFia
 1-3-8 9-0 5-10-9 5-10-9 5-8-1 11-8-10 6-0-6 17-7-0 6-0-6 23-7-8 5-8-1 29-3-7 5-10-9 35-2-0 1-3-8
 Scale = 1:57.6

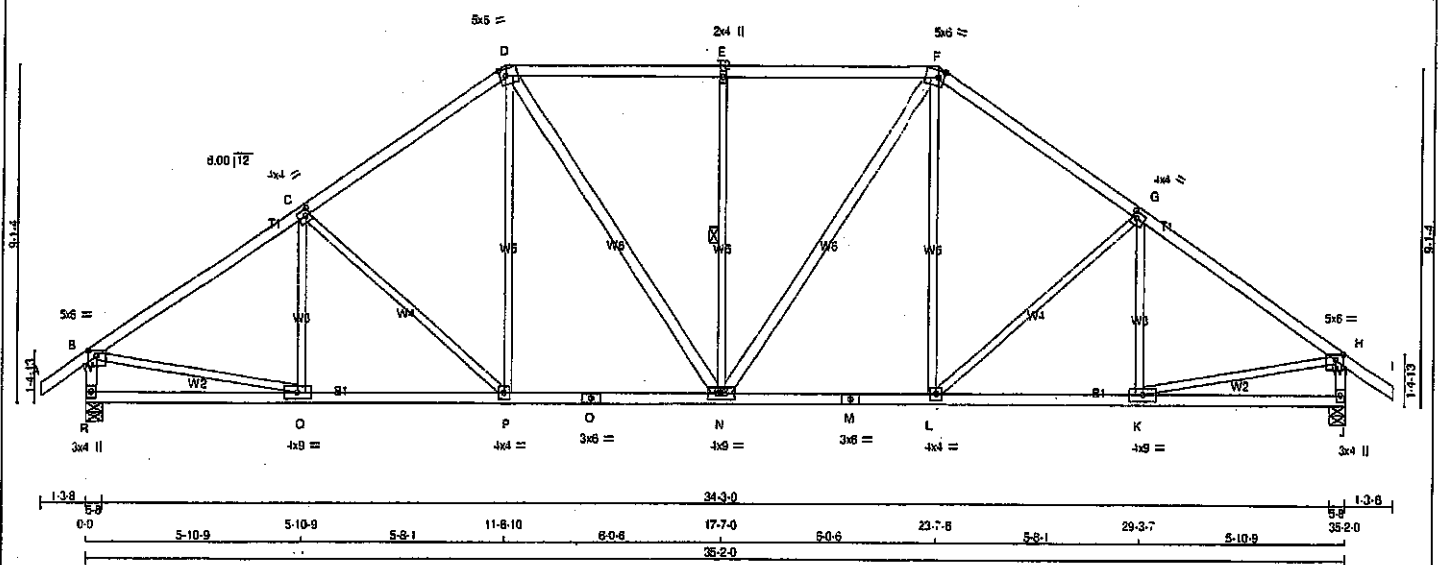

LUMBER				TOTAL WEIGHT = 2 X 165 = 329 lb			
N. L. G. A. RULES				(M/F)			
CHORDS	SIZE	LUMBER	DESCR.	DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER			
A - D	2x4	DRY	No.2	BEARINGS			
D - F	2x4	DRY	No.2	FACTORED MAXIMUM FACTORED INPUT REORD			
F - J	2x4	DRY	No.2	GROSS REACTION GROSS REACTION BRG BRG			
J - B	2x4	DRY	No.2	JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX			
B - H	2x4	DRY	No.2	R 2065 0 2065 0 0 5-8 5-8			
H - O	2x4	DRY	No.2	J 2065 0 2065 0 0 5-8 5-8			
O - M	2x4	DRY	No.2	UNFACTORED REACTIONS			
M - J	2x4	DRY	No.2	1ST LCASE MAX MIN COMPONENT REACTIONS			
ALL WEBS	2x3	DRY	No.2	JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL			
EXCEPT				R 1458 970 0 0 0 0 0 488 0 0 0			
D - N	2x4	DRY	No.2	J 1458 970 0 0 0 0 0 488 0 0 0			
N - F	2x4	DRY	No.2	BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J			
DRY: SEASONED LUMBER.				BRACING			

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.99 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	CSF (LC)
FR-TO		FROM TO		FR-TO			
A-B	0 35	-91.8 -91.8 0.12 (1)	10.00	Q-C	-249 11	0.11 (1)	
B-C	-2346 0	-91.8 -91.8 0.52 (1)	3.99	C-P	-356 0	0.42 (1)	
C-D	-2095 0	-91.8 -91.8 0.48 (1)	4.22	P-D	0 341	0.08 (1)	
D-E	-1985 0	-91.8 -91.8 0.49 (1)	4.26	D-N	0 477	0.08 (1)	
E-F	-1985 0	-91.8 -91.8 0.49 (1)	4.26	N-E	-578 0	0.37 (1)	
F-G	-2095 0	-91.8 -91.8 0.48 (1)	4.22	N-F	0 477	0.08 (1)	
G-H	-2346 0	-91.8 -91.8 0.52 (1)	3.99	L-F	0 341	0.08 (1)	
H-I	0 35	-91.8 -91.8 0.12 (1)	10.00	L-G	-356 0	0.42 (1)	
R-B	-2018 0	0.0 0.0 0.21 (1)	5.94	K-G	-249 11	0.11 (1)	
J-H	-2018 0	0.0 0.0 0.21 (1)	5.94	B-Q	0 2014	0.45 (1)	
				K-H	0 2014	0.45 (1)	
R-Q	0 0	-18.5 -18.5 0.14 (4)	10.00				
Q-P	0 1980	-18.5 -18.5 0.39 (1)	10.00				
P-O	0 1718	-18.5 -18.5 0.34 (1)	10.00				
O-N	0 1718	-18.5 -18.5 0.34 (1)	10.00				
N-M	0 1718	-18.5 -18.5 0.34 (1)	10.00				
M-L	0 1718	-18.5 -18.5 0.34 (1)	10.00				
L-K	0 1981	-18.5 -18.5 0.39 (1)	10.00				
K-J	0 0	-18.5 -18.5 0.14 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, OBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-08, CSA 086-14
 - TPIC 2011, TPIC 2014

15% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
 CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
 ALLOWABLE DEFL.(TL) = L/360 (1.17)
 CALCULATED VERT. DEFL.(TL) = L/999 (0.19")

CSI: TC=0.52/1.00 (G-H:1), BC=0.39/1.00 (K-L:1), WB=0.45/1.00 (H-K:1), SS=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1657 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (H) (INPUT = 0.80)

JSI METAL = 0.56 (H) (INPUT = 1.00)

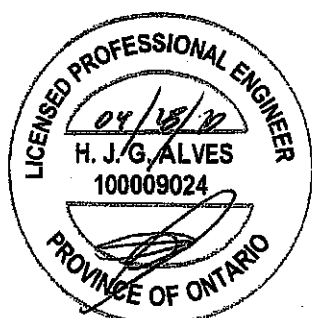


Structural component only
 DWG# T-2007608

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T7	6	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:10 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1f-7wWap4FR98cCOzhO7Uz5VD4qIMXPTGWa8xC7FzMFIZ

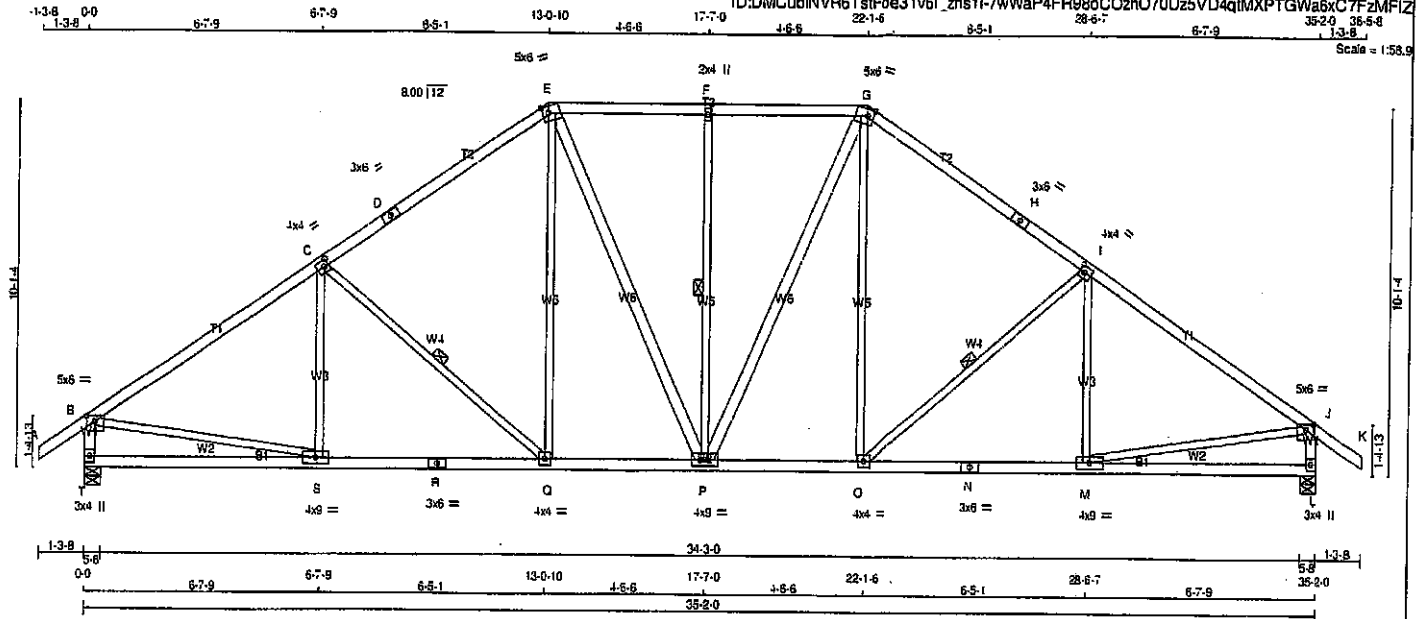

TOTAL WEIGHT = 8 X 172 = 1030 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - G	2x4	DRY	No.2	SPF	
G - H	2x4	DRY	No.2	SPF	
H - K	2x4	DRY	No.2	SPF	
T - B	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
T - R	2x4	DRY	No.2	SPF	
R - N	2x4	DRY	No.2	SPF	
N - L	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
E - P	2x4	DRY	No.2	SPF	
P - G	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	5.0	6.0	1.75	2.75
C	TMWW-t	MT20	4.0	4.0	2.00	1.50
D	TS-t	MT20	3.0	6.0		
E	TTWW-m	MT20	5.0	6.0	2.25	2.00
F	TMWW-w	MT20	2.0	4.0		
G	TTWW-m	MT20	5.0	6.0	2.25	2.00
H	TS-t	MT20	3.0	6.0		
I	TMWW-t	MT20	4.0	4.0	2.00	1.50
J	TMWW-p	MT20	5.0	6.0	1.75	2.75
L	BMV1-p	MT20	3.0	4.0		
M	BMWW-t	MT20	4.0	9.0		
N	BS-t	MT20	3.0	6.0		
O	BMWW-t	MT20	4.0	4.0		
P	BMWW-t	MT20	4.0	9.0		
Q	BMWW-t	MT20	4.0	4.0		
R	BS-t	MT20	3.0	6.0		
S	BMWW-t	MT20	4.0	9.0		
T	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UP	IN-SX
T	2065	0	0	5-8
L	2065	0	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX./MIN.	COMPONENT REACTIONS	PERM.LIVE	WIND	DEAD	SOIL
T	1458	970.0	0.0	0.0	0.0	488.0	0.0
L	1458	970.0	0.0	0.0	0.0	488.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1:2 LENGTH OF C-Q, F-P, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 35	-91.8 -91.8 0.12 (1)	S-C	-189 46
B-C	-2358 0	-91.8 -91.8 0.89 (1)	C-Q	-484 0
C-D	-1996 0	-91.8 -91.8 0.82 (1)	Q-E	0 415
D-E	-1996 0	-91.8 -91.8 0.82 (1)	E-P	0 315
E-F	-1761 0	-91.8 -91.8 0.27 (1)	P-F	-502 0
F-G	-1761 0	-91.8 -91.8 0.27 (1)	P-G	0 315
G-H	-1996 0	-91.8 -91.8 0.82 (1)	O-G	0 415
H-I	-1996 0	-91.8 -91.8 0.82 (1)	O-I	-484 0
I-J	-2358 0	-91.8 -91.8 0.89 (1)	M-I	-189 46
J-K	0 35	-91.8 -91.8 0.12 (1)	B-S	0 2021
T-B	-2014 0	0.0 0.0 0.21 (1)	M-J	0 2021
L-J	-2014 0	0.0 0.0 0.21 (1)		
T-S	0 0	-18.5 -18.5 0.19 (4)		
S-R	0 1995	-18.5 -18.5 0.42 (1)		
R-O	0 1995	-18.5 -18.5 0.42 (1)		
Q-P	0 1629	-18.5 -18.5 0.32 (1)		
P-O	0 1629	-18.5 -18.5 0.32 (1)		
O-N	0 1995	-18.5 -18.5 0.42 (1)		
N-M	0 1995	-18.5 -18.5 0.42 (1)		
M-L	0 0	-18.5 -18.5 0.19 (4)		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CSI: TC=0.69/1.00 (I-J-1), BC=0.42/1.00 (M-O-1),
WB=0.45/1.00 (J-K-1), SS=0.24/1.00 (I-J-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1897 788


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (J) (INPUT = 0.90)
JSI METAL = 0.87 (N) (INPUT = 1.00)



Structural component only
DWG# T-2007609

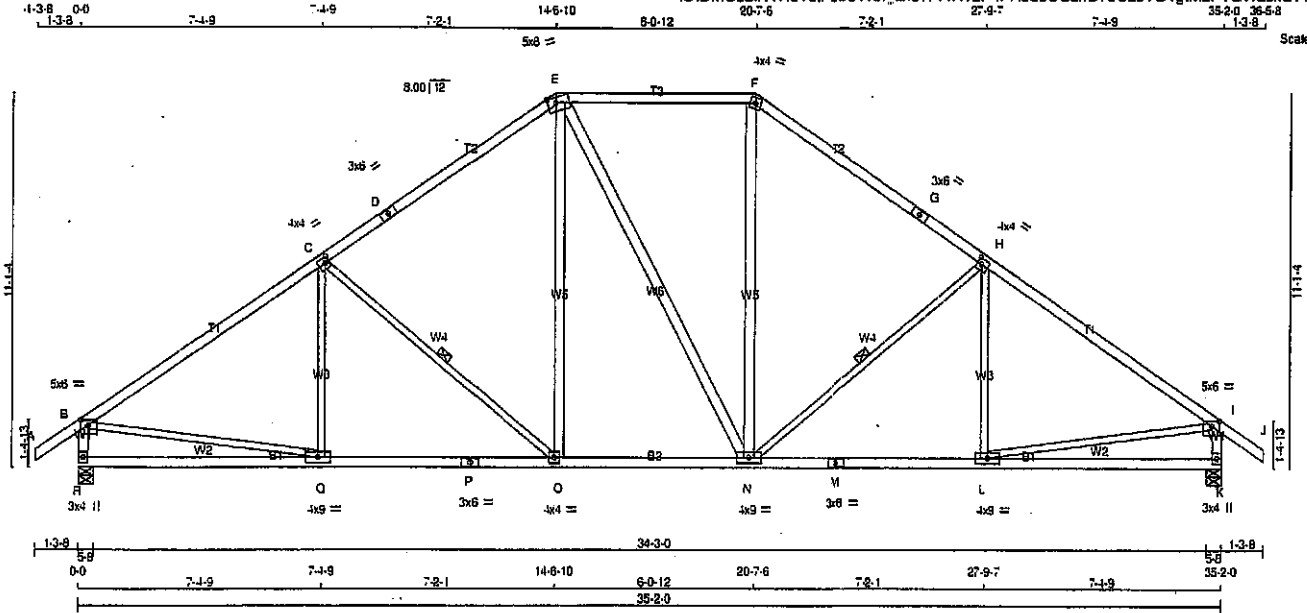

TOTAL WEIGHT = 2 X 186 = 333 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
J - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2
M - K	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
EXCEPT			
O - E	2x4	DRY	No.2
E - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	6.0	1.75 2.75
C	TMVW-l	MT20	4.0	4.0	2.00 1.50
D	TS-l	MT20	3.0	6.0	
E	TTWV-m	MT20	5.0	8.0	2.00 3.00
F	TTW-m	MT20	4.0	4.0	
G	TS-l	MT20	3.0	6.0	
H	TMVW-l	MT20	4.0	4.0	2.00 1.50
I	TMVW-p	MT20	5.0	6.0	1.75 2.75
K	BMV1+p	MT20	3.0	4.0	
L	BMVW-l	MT20	4.0	9.0	
M	BS-l	MT20	3.0	6.0	
N	BMVWV-l	MT20	4.0	9.0	
O	BMVW-l	MT20	4.0	4.0	
P	BS-l	MT20	3.0	6.0	
Q	BMVW-l	MT20	4.0	9.0	
R	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED	MAXIMUM FACTORED		INPUT		RECORD	
	GROSS REACTION	DOWN	HORIZ	BRG	IN-SX	IN-SX	
JT	VERT						
R	2085	0	2085	0	5-8	5-8	
K	2085	0	2085	0	5-8	5-8	

UNFACTORED REACTIONS							
JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1458	970	0	0	0	488	0
K	1458	970	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.45 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (LBS)	MAX. FACTORED (PLF) CSI (LC)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED (PLF) CSI (LC)
FR-TO					FR-TO		
A-B	0 35	-91.8	-91.8 0.12 (1)	10.00	Q-C	-140 76	0.09 (1)
B-C	-2357 0	-91.8	-91.8 0.89 (1)	3.45	O-D	-604 0	0.38 (1)
C-D	-1888 0	-91.8	-91.8 0.78 (1)	3.91	O-E	0 499	0.08 (1)
D-E	-1888 0	-91.8	-91.8 0.78 (1)	3.91	E-N	0 0	0.00 (1)
E-F	-1538 0	-91.8	-91.8 0.47 (1)	4.74	N-F	0 500	0.08 (1)
F-G	-1888 0	-91.8	-91.8 0.78 (1)	3.91	N-H	-604 0	0.38 (1)
G-H	-1888 0	-91.8	-91.8 0.78 (1)	3.91	L-H	-140 75	0.09 (1)
H-I	-2357 0	-91.8	-91.8 0.89 (1)	3.45	B-Q	0 2020	0.45 (1)
I-J	0 35	-91.8	-91.8 0.12 (1)	10.00	L-I	0 2019	0.45 (1)
R-B	-2009 0	0.0	0.0 0.21 (1)	5.95			
K-I	-2009 0	0.0	0.0 0.21 (1)	5.95			
R-Q	0 0	-18.5	-18.5 0.25 (4)	10.00			
O-P	0 1998	-18.5	-18.5 0.45 (1)	10.00			
P-O	0 1998	-18.5	-18.5 0.45 (1)	10.00			
O-N	0 1538	-18.5	-18.5 0.33 (1)	10.00			
N-M	0 1998	-18.5	-18.5 0.45 (1)	10.00			
M-L	0 1998	-18.5	-18.5 0.45 (1)	10.00			
L-K	0 0	-18.5	-18.5 0.24 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 085-14
 - TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
 CALCULATED VERT. DEFL.(LL) = L/999 (0.09')
 ALLOWABLE DEFL.(TL) = L/360 (1.17')
 CALCULATED VERT. DEFL.(TL) = L/999 (0.20')

CSI: TC=0.89/1.00 (B-C:1), BC=0.45/1.00 (C-Q:1), WB=0.45/1.00 (B-Q:1), SS=0.27/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1857 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.90 (F) INPUT=0.90
 JSI METAL=0.68 (P) INPUT=1.00




Structural component only
 DWG# T-2007610

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T9	1	2	GREEN PARK HOMES	

Tamrack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:00:11 2020 Page 1
ID:DMCubINVR6tstFoe31v6l_zns1l-b64ydQG4wSx3?77Gahj?CeimKBHhB8zfpmgmfiZMFIY

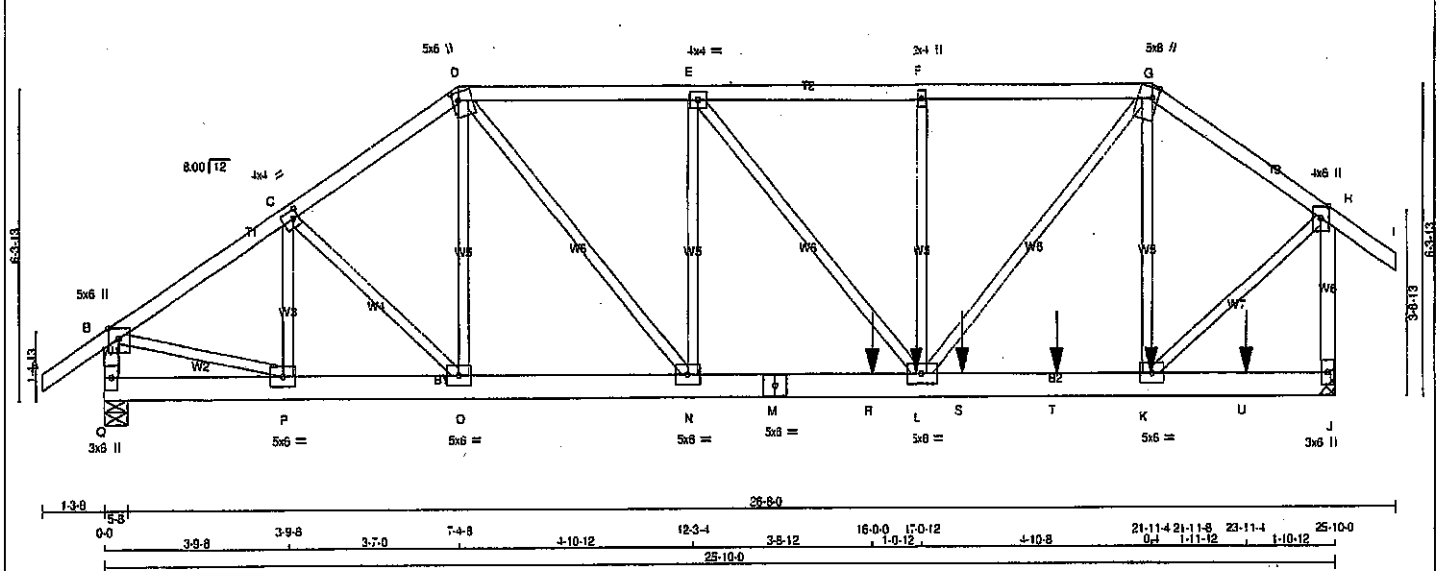

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4 DRY	No.2	SPF		
D - G	2x4 DRY	No.2	SPF		
G - I	2x4 DRY	No.2	SPF		
O - B	2x4 DRY	No.2	SPF		
J - H	2x4 DRY	No.2	SPF		
Q - M	2x6 DRY	No.2	SPF		
M - J	2x6 DRY	No.2	SPF		
ALL WEBS EXCEPT	2x3 DRY	No.2	SPF		

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - D	12	TOP
D - G	12	TOP
G - I	12	TOP
O - B	12	TOP
J - H	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
Q - M	12	TOP
M - J	12	SIDE(183.11)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	UPLIFT
Q	2236	0	2239	0
J	3067	0	3067	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 4-0.

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED
Q	1575
J	2157

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (LBS)
FR-TO				FR-TO		
A-B	0 35	-91.8	0.07 (1)	P-C	-503	0 06 (1)
B-C	-2484	-91.8	0.13 (1)	C-O	0 70	0.01 (1)
C-D	-2571	-91.8	0.13 (1)	O-D	-2 80	0.01 (1)
D-E	-3030	-91.8	0.20 (1)	D-N	0 1433	0.18 (1)
E-F	-3235	-91.8	0.21 (1)	N-E	-738	0 22 (1)
F-G	-3235	-91.8	0.20 (1)	E-L	0 327	0.04 (1)
G-H	-2123	-91.8	0.15 (1)	L-F	-489	0 14 (1)
H-I	0 35	-91.8	0.07 (1)	I-G	0 2339	0.29 (1)
Q-B	-2165	0 0	0.12 (1)	K-G	-995	0 30 (1)
J-H	-2962	0 0	0.33 (1)	B-P	0 2137	0.28 (1)
				K-H	0 2299	0.28 (1)
Q-P	0 0	-18.5	0.02 (1)			
P-O	0 2067	-18.5	0.16 (1)			
O-N	0 2118	-18.5	0.22 (1)			
N-M	0 3030	-18.5	0.45 (1)			
M-R	0 3030	-18.5	0.45 (1)			
R-L	0 3030	-18.5	0.45 (1)			
L-S	0 1746	-18.5	0.27 (1)			
S-T	0 1746	-18.5	0.27 (1)			
T-K	0 1746	-18.5	0.27 (1)			
K-U	0 0	-18.5	0.06 (1)			
U-J	0 0	-18.5	0.06 (1)			

FACTORED CONCENTRATED LOADS (LBS)	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
JT	21-11-4	-187	-187	---	FRONT	VERT	TOTAL	---	C1
K	16-11-4	-187	-187	---	FRONT	VERT	TOTAL	---	C1
L	16-0-0	-1259	-1259	---	FRONT	VERT	TOTAL	---	C1
R	17-11-4	-187	-187	---	FRONT	VERT	TOTAL	---	C1
S	19-11-4	-187	-187	---	FRONT	VERT	TOTAL	---	C1
T	23-11-4	-195	-195	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.86")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (0.86")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.33/1.00 (H-J:1), BC=0.45/1.00 (L-N:1), WB=0.30/1.00 (G-K:1), SSI=0.35/1.00 (L-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(P.S.I.) (P.L.I.) (P.L.I.)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.91 (H) (INPUT = 0.90)
JSI METAL = 0.53 (H) (INPUT = 1.00)



Structural component only
DWG# T-2007611 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T9	1	2	GREEN PARK HOMES	
				TRUSS DESC.	


Tamarack Roof Truss, Burlington

Version 8.3 10 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:11 2020 Page 2
ID:DMCubINVR6TstFoe31y6I zns1I-b64yQGG4wSx377Gahi?CeimKBHhBBztomamfizMFIY


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	Edge	
C	TMWW-l	MT20	4.0	4.0	2.00	1.50
D	TTWW+m	MT20	5.0	6.0	2.00	1.50
E	TMWW-l	MT20	4.0	4.0		
F	TMW+w	MT20	2.0	4.0		
G	TTWW+m	MT20	5.0	8.0	2.50	1.50
H	TMVW+p	MT20	4.0	6.0	Edge	
J	BMV1+p	MT20	3.0	6.0		
K, N, O, P						
K	BMWW-l	MT20	5.0	6.0		
L	BMWW-l	MT20	5.0	8.0		
M	BS-l	MT20	5.0	6.0		
Q	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

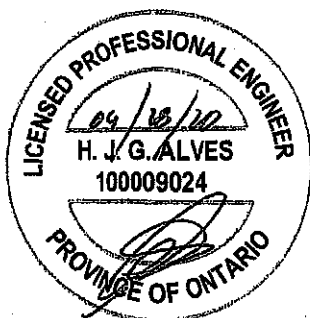

Structural component only
DWG# T-2007611

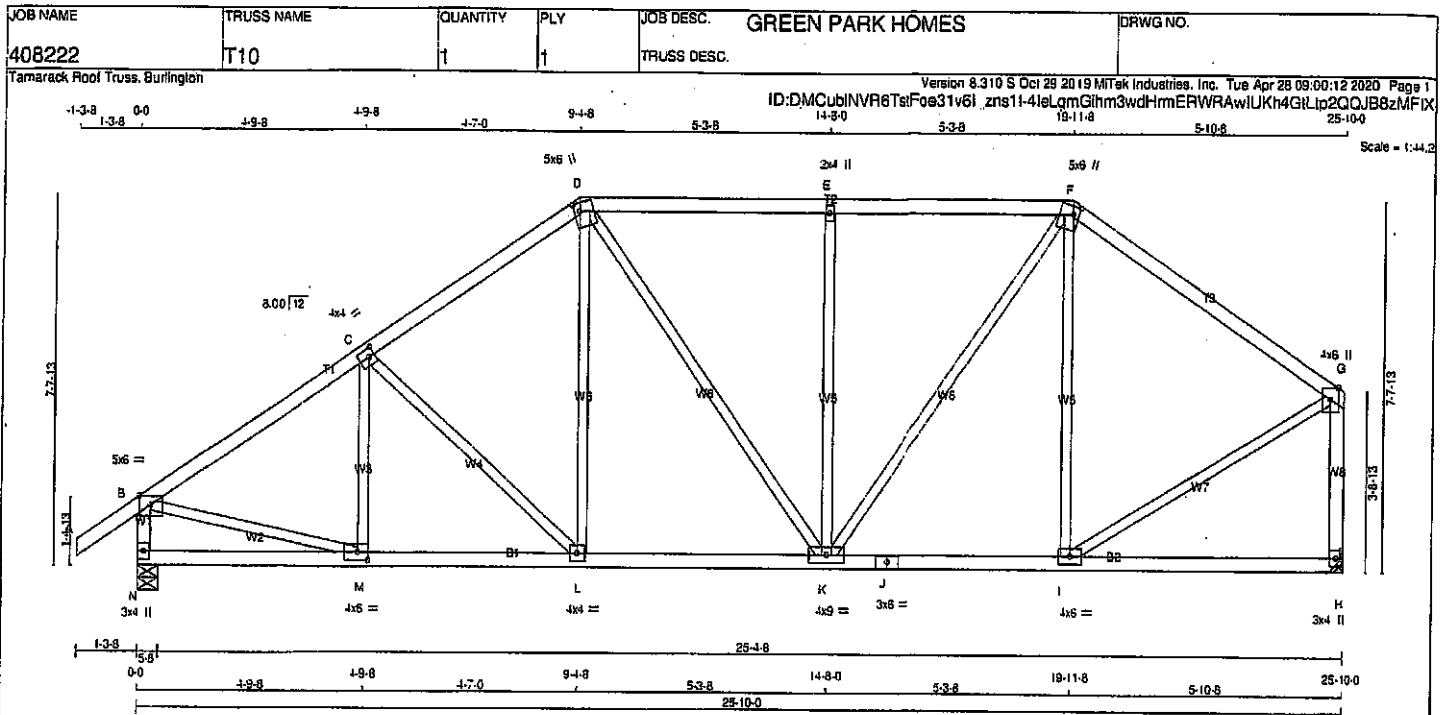

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										TOTAL WEIGHT = 118.6 (M.F)			
N. L. G. A. RULES				BEARINGS										DESIGN CRITERIA			
CHORDS		SIZE	LUMBER	DESCR.	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		RECORD BRG		SPECIFIED LOADS:				
A - D	2x4	DRY	No.2	SPF	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	TOP CH.	LL' = 25.6 PSF			
D - F	2x4	DRY	No.2	SPF	N	1550	0	1550	0	0	5-8	5-8	DL	= 6.0 PSF			
F - G	2x4	DRY	No.2	SPF	H	1424	0	1424	0	0	MECHANICAL		LL	= 0.0 PSF			
N - B	2x4	DRY	No.2	SPF	A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.										DL	= 7.4 PSF	
H - G	2x4	DRY	No.2	SPF											TOTAL LOAD = 39.0 PSF		
N - J	2x4	DRY	No.2	SPF													
J - H	2x4	DRY	No.2	SPF											SPACING = 24.0 IN.C/C		
ALL WEBS		2x3	DRY	No.2	SPF												

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge	
C	TMVW-w	MT20	4.0	4.0	2.00	1.50
D	TTVW-w	MT20	5.0	6.0	2.00	1.50
E	TMVW-w	MT20	2.0	4.0		
F	TTVW-w	MT20	5.0	6.0	2.00	1.50
G	TMVW-p	MT20	4.0	6.0	Edge	
H	BMV1-p	MT20	3.0	4.0		
I	BMVW-w	MT20	4.0	6.0		
J	BS-t	MT20	3.0	6.0		
K	BMVW-w	MT20	4.0	6.0		
L	BMVW-w	MT20	4.0	4.0		
M	BMVW-w	MT20	4.0	6.0	2.00	2.50
N	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
N	1094	731	0	0	0	363	0
H	1007	681	0	0	0	346	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.93 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	UNBRACED LENGTH
FR-TO				FR-TO			
A-B	0	35	-91.8	-91.8	0.12	(1)	10.00
B-C	-1609	0	-91.8	-91.8	0.29	(1)	4.93
C-D	-1425	0	-91.8	-91.8	0.28	(1)	5.17
D-E	-1272	0	-91.8	-91.8	0.35	(1)	5.30
E-F	-1272	0	-91.8	-91.8	0.35	(1)	5.30
F-G	-1077	0	-91.8	-91.8	0.43	(1)	5.52
N-B	-1511	0	0.0	0.0	0.16	(1)	6.68
H-G	-1380	0	0.0	0.0	0.32	(1)	6.92
N-M	0	0	-18.5	-18.5	0.09	(4)	10.00
M-L	0	1362	-18.5	-18.5	0.27	(1)	10.00
L-K	0	1164	-18.5	-18.5	0.24	(1)	10.00
K-J	0	890	-18.5	-18.5	0.23	(1)	10.00
J-I	0	890	-18.5	-18.5	0.23	(1)	10.00
I-H	0	0	-18.5	-18.5	0.15	(4)	10.00

ALLOWABLE DEFL.(LL) = L/360 (0.96")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.96")
CALCULATED VERT. DEFL.(TL) = L/999 (0.09")

CSI: TC=0.43/1.00 (F-G:1), BC=0.27/1.00 (L-M:1)
WB=0.64/1.00 (E-K:1), SSI=0.23/1.00 (E-F:1)

DCL LUMBER=1.00 NAIL=1.00 LBS BEND= 1 10
COMP=1.10 SHEAR=1.10 TENS= 1.10


COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (B) (INPUT = 0.80)
JSI METAL = 0.55 (G) (INPUT = 1.00)

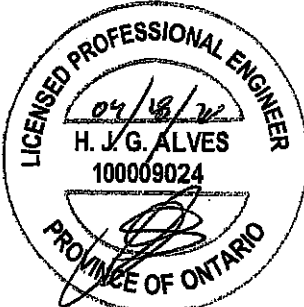

Structural component only
DWG# T-2007612.

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T11A	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

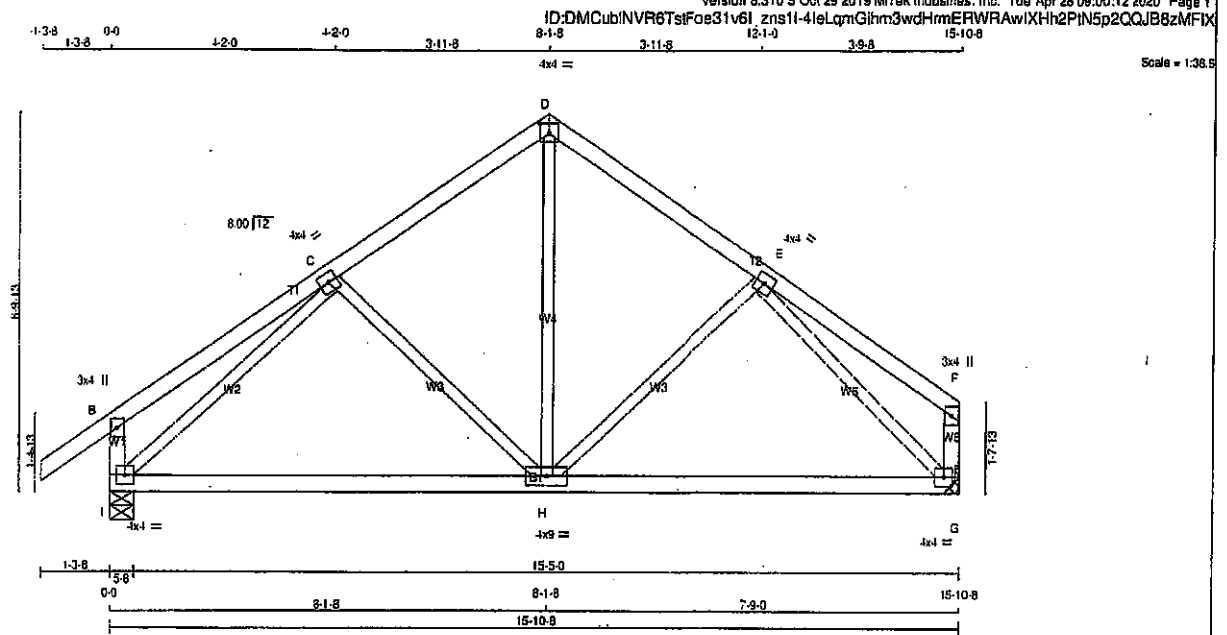

TOTAL WEIGHT = 2 X 66 = 133 lb [M/F]

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N.L.G.A. RULES	A - D	2x4	DRY	No.2
	D - F	2x4	DRY	No.2
	I - B	2x4	DRY	No.2
	G - F	2x4	DRY	No.2
	I - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
DRY: SEASONED LUMBER.				

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-t	MT20	4.0	4.0		
D	TTW-p	MT20	4.0	4.0	2.25	2.00
E	TMVW-t	MT20	4.0	4.0		
F	TMV+p	MT20	3.0	4.0		
G	BMVW1-t	MT20	4.0	4.0		
H	BMVW1-t	MT20	4.0	9.0		
I	BMVW1-t	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	UPLIFT
I	1001	0	1001	0
G	875	0	875	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

1ST LCASE	JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
I	706	476	0	0	0	0	229	0
G	619	406	0	0	0	0	213	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 35	-91.8	-91.8 0.12 (1)	C-H	-228 0	0 12.1 (1)	
B-C	0 24	-91.8	-91.8 0.24 (1)	H-D	0 449	0 1.10 (1)	
C-D	-891 0	-91.8	-91.8 0.19 (1)	D-E	-168 0	0 0.08 (1)	
D-E	-689 0	-91.8	-91.8 0.17 (1)	E-F	-988 0	0 0.50 (1)	
E-F	0 24	-91.8	-91.8 0.22 (1)	F-G	-971 0	0 0.44 (1)	
F-G	-269 0	0 0	0 0.03 (1)				
G-F	-125 0	0 0	0 0.01 (1)				
I-H	0 722	-18.5	-18.5 0.39 (4)				
H-G	0 677	-18.5	-18.5 0.39 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.53")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.53")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TC=0.24/1.00 (B-C:1), BC=0.39/1.00 (H-I:4), WB=0.50/1.00 (C-I:1), SS=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (I) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1967 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.84 (E) (INPUT = 0.90)
JSI METAL = 0.35 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007613

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:04:01 2020 Page 1
ID:DMCubINVR6TstFoe31v6l zns1l-SxVsS1cVvDTdV3g25iMsNOiHbxxWB7PwS04izMEMi

Scale = 1:38.5

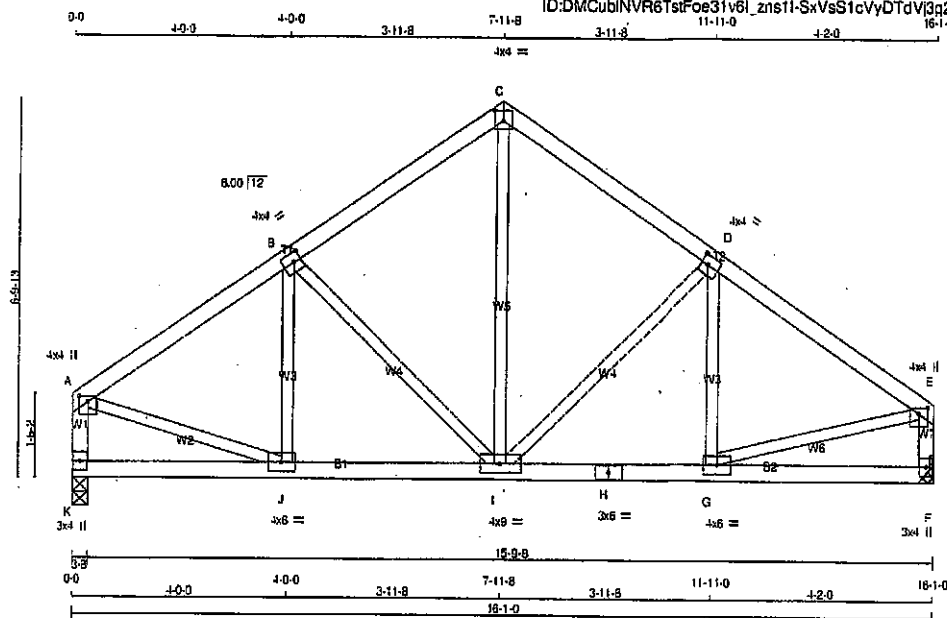

TOTAL WEIGHT = 2 X 69 = 137 lb

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMWV+p	MT20	4.0	4.0	1.25 2.00
B	TMWV-I	MT20	4.0	4.0	2.00 1.50
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TMWV-I	MT20	4.0	4.0	2.00 1.50
E	TMWV+p	MT20	4.0	4.0	1.25 2.00
F	BMV1+p	MT20	3.0	4.0	
G	BMWV-I	MT20	4.0	8.0	
H	BS-I	MT20	3.0	6.0	
I	BMWVW-I	MT20	4.0	9.0	
J	BMWV-I	MT20	4.0	6.0	
K	BMV1+p	MT20	3.0	4.0	

SEALING BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
K	887	0	887	0	0	3-B	3-B
F	887	0	887	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT E = 3'-8"

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	627	411 0	0 0	0 0	0 0	215 0	0 0
F	627	413 0	0 0	0 0	0 0	218 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MEMB.		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LG1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	-868 0	-91.8	-91.8 0.19 (1)	6.25	J-B	-142 18	0.04 (1)
B-C	-687 0	-91.8	-91.8 0.18 (1)	6.25	B-I	-263 0	0.13 (1)
C-D	-689 0	-91.8	-91.8 0.20 (1)	6.25	I-C	0 461	0.10 (1)
D-E	-991 0	-91.8	-91.8 0.19 (1)	6.25	I-D	-292 0	0.15 (1)
K-A	-855 0	0.0	0.0 0.09 (1)	7.81	G-D	-117 28	0.03 (1)
F-E	-853 0	0.0	0.0 0.09 (1)	7.81	A-J	0 772	0.17 (1)
					G-E	0 787	0.18 (1)
K-J	0 0	-18.5	-18.5 0.07 (4)	10.00			
J-I	0 740	-18.5	-18.5 0.15 (1)	10.00			
I-H	0 761	-18.5	-18.5 0.15 (1)	10.00			
H-G	0 761	-18.5	-18.5 0.15 (1)	10.00			
G-F	0 0	-18.5	-18.5 0.07 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

SPECIFIED LOADS:				
TOP	CH.	LL	=	25.6 PSF
		DL	=	6.0 PSF
BOT	CH.	LL	=	0.0 PSF
		DL	=	7.4 PSF
TOTAL LOAD			=	39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9.
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L 999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L 999 (0.03")

CSI: TC=0.20/1.00 (D-E:1), BC=0.15/1.00 (G-I:1),
WB=0.18/1.00 (E-G:1), SS=0.15/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.85 (E) (INPUT = 0.90)
JSI METAL= 0.25 (H) (INPUT = 1.00)

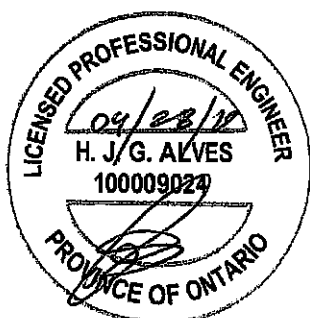


Structural component only
DWG# T-2007631

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T11S	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 09:00:13 2020 Page 1
ID:DMCubINVR6TsiFoe31v8I_zns1I-YVC26HKS3BnFRQzo81gI7reK5PdcqyG49siazMFIV

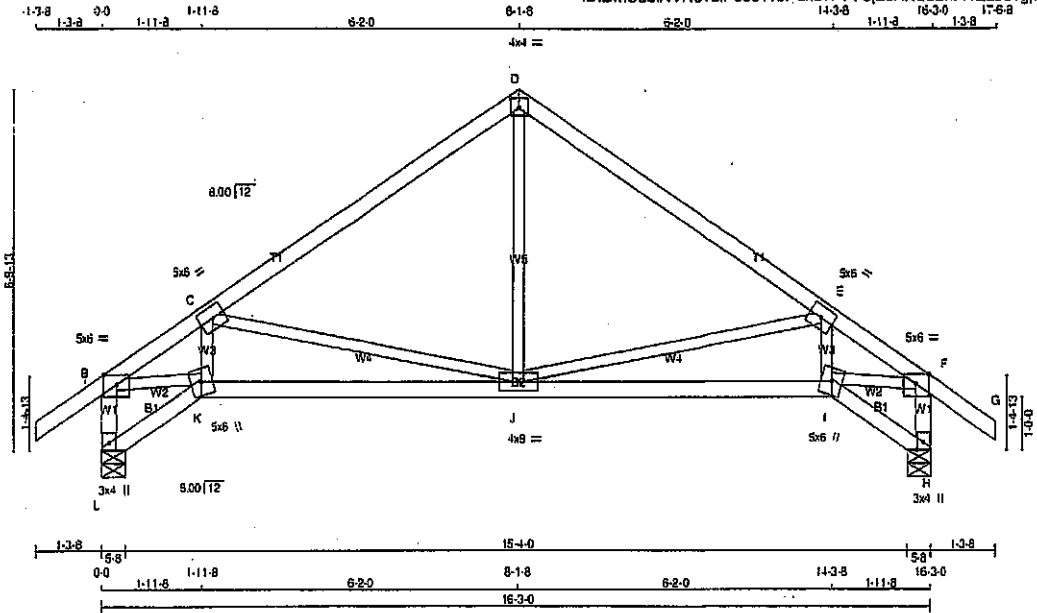

TOTAL WEIGHT = 2 X 67 = 134 lb
(M/F)

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. L - B 2x4 DRY No.2 SPF A - D 2x4 DRY No.2 SPF D - G 2x4 DRY No.2 SPF H - F 2x4 DRY No.2 SPF L - K 2x4 DRY No.2 SPF K - I 2x4 DRY No.2 SPF I - H 2x4 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF DRY: SEASONED LUMBER.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY: BUILDING DESIGNER BEARINGS FACTORED MAXIMUM FACTORED INPUT REQD GROSS REACTION GROSS REACTION BRG BRG JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX L 1022 0 1022 0 0 5-8 5-8 H 1022 0 1022 0 0 5-8 5-8 UNFACTORED REACTIONS 1ST LCASE MAX. MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL L 720 486 0 0 0 0 234 0 0 H 720 486 0 0 0 0 234 0 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS I, L, H BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.97 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS WEBS MAX. FACTORED MAX. FACTORED MEMB. FORCE VERT. LOAD LC1 MAX. MAX. MEMB. MAX. FORCE (LBS) (PLF) CSI (LC) UNBRAC LENGTH FR-TO (LBS) CSI (LC) FR-TO FROM TO L-B -1004 0 0.0 0.0 0.11 (1) 7.80 B-K 0 1321 0.30 (1) A-B 0 35 -91.8 -91.8 0.12 (1) 10.00 K-C 0 55 0.02 (4) B-C -1508 0 -91.8 -91.8 0.33 (1) 4.97 C-J -659 0 0.48 (1) C-D -841 0 -91.8 -91.8 0.41 (1) 6.03 J-D 0 444 0.10 (1) D-E -841 0 -91.8 -91.8 0.42 (1) 8.07 J-E -661 0 0.47 (1) E-F -1510 0 -91.8 -91.8 0.33 (1) 4.97 I-E 0 56 0.02 (4) F-G 0 35 -91.8 -91.8 0.12 (1) 10.00 I-F 0 1323 0.30 (1) H-F -1004 0 0.0 0.0 0.11 (1) 7.80 L-K 0 0 -18.5 -18.5 0.02 (4) 10.00 K-J 0 1319 -18.5 -18.5 0.33 (1) 10.00 J-I 0 1320 -18.5 -18.5 0.33 (1) 10.00 I-H 0 0 -18.5 -18.5 0.02 (4) 10.00				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 8.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2010, CBC 2012, ABC 2019 - PART 8 OF CBC 2012 (2019 AMENDMENT) - CSA 086-09, CSA 086-14 - TPIC 2011, TPIC 2014 155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL) = L/360 (0.54") CALCULATED VERT. DEFL.(LL) = L/999 (0.03") ALLOWABLE DEFL.(TL) = L/360 (0.54") CALCULATED VERT. DEFL.(TL) = L/999 (0.03") CSI: TC=0.42(1.00 (D-E:1), BC=0.33(1.00 (I-J:1), WB=0.47(1.00 (E-J:1), SS=0.21(1.00 (D-E:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 1.00 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (P.S.I) (P.L.I) (P.L.I) MAX MIN MAX MIN MAX MIN MT20 618 354 1867 788 1987 1858 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.99 (I) (INPUT = 0.90) JSI METAL= 0.47 (K) (INPUT = 1.00)			
---	--	--	--	--	--	--	--	--	--	--	--




Structural component only
DWG# T-2007614

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T12S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Apr 28 09:00:14 2020 Page 1

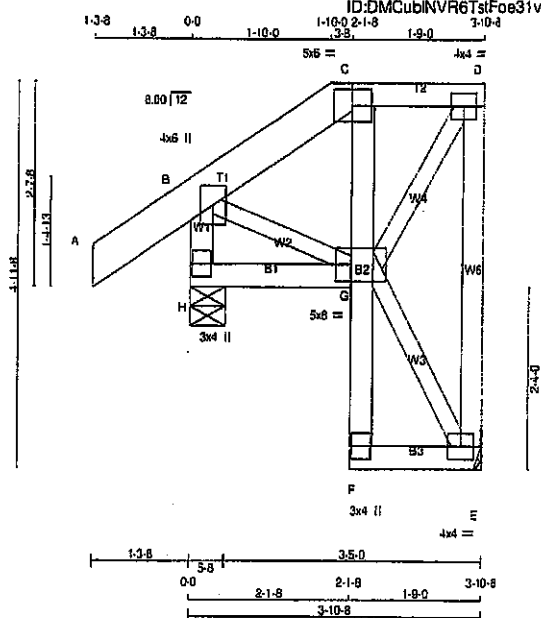

Scale = 1/27.5

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x6	DRY	No.2
C - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
H - B	2x4	DRY	No.2
H - G	2x4	DRY	No.2
F - C	2x4	DRY	No.2
F - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	6.0		
C	TTV-m	MT20	5.0	6.0		
D	TMVW-1	MT20	4.0	4.0		
F	BMVW-1	MT20	4.0	4.0		
F	BMV+p	MT20	3.0	4.0		
G	BMVWW-1	MT20	5.0	8.0	2.50	2.50
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
E	214	0	214	0
H	344	0	344	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	151	99	0	0	0	52	0
H	241	172	0	0	0	69	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 36	-91.8 -91.8	0.07 (5)	10.00	G-D	0 139	0.03 (1)
B-C	-105 0	-91.8 -91.8	0.03 (1)	6.25	B-G	0 96	0.02 (1)
C-D	-79 0	-91.8 -91.8	0.05 (1)	6.25	G-E	-3 0	0.00 (1)
E-D	-196 0	0.0 0.0	0.03 (1)	7.81			
H-B	-323 0	0.0 0.0	0.03 (1)	7.81			
H-G	0 0	-18.5 -18.5	0.03 (4)	10.00			
F-G	0 17	0.0 0.0	0.01 (1)	10.00			
G-C	-119 0	0.0 0.0	0.01 (1)	7.81			
F-E	0 2	-18.5 -18.5	0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 31 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.08(1.00), D-E(1), BC=0.03(1.00) (G-H(4)), WB=0.03(1.00), D-G(1), SS=0.07(1.00) (A-B(5))

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX	MIN	MAX
MT20	618	354
	1667	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (B) (INPUT = 0.90)
JSI METAL = 0.11 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007615

ID:DMCubINVR61stFoe31v6l zns1l-x73EgNd7XbU6sesc0bPaw0PaBNFZ7YIIB c8zMEMh
 23-10-14 35-20 1-3-8 Scale = 1:57.8

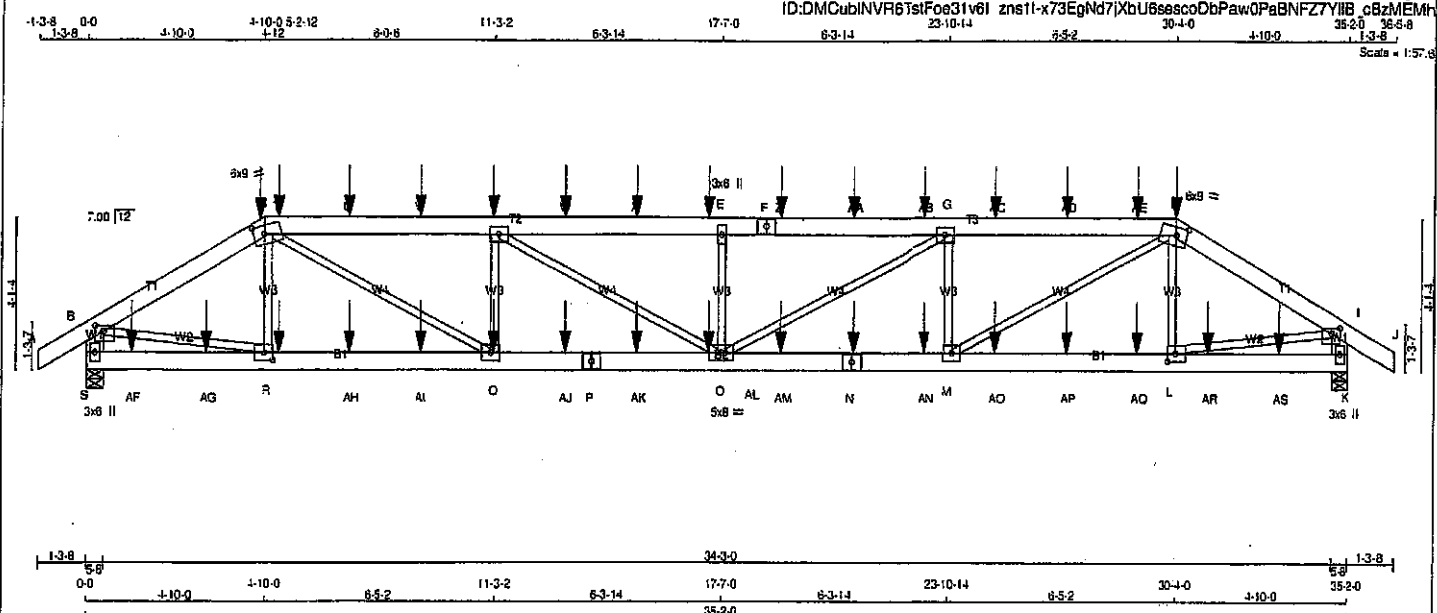

LUMBER

N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x6	DRY	No.2	SPF
C - F	2x6	DRY	No.2	SPF
F - H	2x6	DRY	No.2	SPF
H - J	2x6	DRY	No.2	SPF
S - B	2x6	DRY	No.2	SPF
K - I	2x6	DRY	No.2	SPF
S - P	2x6	DRY	No.2	SPF
P - N	2x6	DRY	No.2	SPF
N - K	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
 EXCEPT

DRY: SEASONED LUMBER.
 DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS SURFACE SPACING (IN) LOAD (PLF)

TOP CHORDS: (0.122"x3") SPIRAL NAILS	SIZE	LOAD (PLF)
A-C	2	12
C-F	2	12
F-H	2	12
H-J	2	12
S-B	2	12
K-I	2	12

BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS

SIZE	LOAD (PLF)
S-P	2
P-N	2
N-K	2

WEBS: (0.122"x3") SPIRAL NAILS
 2x3 1 6

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT VERT	3423	0	0
S	3423	0	0
K	3365	0	0

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	2418
S	1800
K	1573

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS) S, K

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.03 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

(LBS)		(PLF)		CS1 (LC)		UNBRAC		(LBS)		CS1 (LC)	
FR-TO		FROM	TO	LENGTH	FR-TO						
A-B	0 33	-91.8	-91.8	0.04 (1)	10.00	R-C	-431 9			0.05 (1)	
B-C	-4681 0	-91.8	-91.8	0.13 (1)	5.23	C-Q	0 3534			0.44 (1)	
C-T	-7102 0	-91.8	-91.8	0.31 (1)	4.26	Q-D	-1555 0			0.19 (1)	
T-U	-7102 0	-91.8	-91.8	0.31 (1)	4.26	D-O	0 1048			0.13 (1)	
U-V	-7102 0	-91.8	-91.8	0.31 (1)	4.26	O-E	-864 0			0.10 (1)	
V-D	-7102 0	-91.8	-91.8	0.31 (1)	4.26	E-G	0 1085			0.13 (1)	
D-W	-8010 0	-91.8	-91.8	0.32 (1)	4.05	M-G	-1573 0			0.19 (1)	
W-X	-8010 0	-91.8	-91.8	0.32 (1)	4.05	M-H	0 3572			0.44 (1)	
X-Y	-8010 0	-91.8	-91.8	0.32 (1)	4.05	L-H	-421 10			0.05 (1)	
Y-E	-8010 0	-91.8	-91.8	0.32 (1)	4.05	B-R	0 4088			0.51 (1)	
E-F	-8010 0	-91.8	-91.8	0.33 (1)	4.03	L-I	0 4022			0.50 (1)	
F-Z	-8010 0	-91.8	-91.8	0.33 (1)	4.03						
Z-AA	-8010 0	-91.8	-91.8	0.33 (1)	4.03						
AA-AB	-8010 0	-91.8	-91.8	0.33 (1)	4.03						
AB-G	-8010 0	-91.8	-91.8	0.33 (1)	4.03						
G-AC	-7070 0	-91.8	-91.8	0.30 (1)	4.27						
AC-AD	-7070 0	-91.8	-91.8	0.30 (1)	4.27						
AD-AE	-7070 0	-91.8	-91.8	0.30 (1)	4.27						
AE-H	-7070 0	-91.8	-91.8	0.30 (1)	4.27						
H-I	-4606 0	-91.8	-91.8	0.13 (1)	5.26						
I-J	0 33	-91.8	-91.8	0.04 (1)	10.00						
S-B	-3367 0	0.0	0.0	0.12 (1)	7.58						
K-I	-3318 0	0.0	0.0	0.12 (1)	7.63						

S-AF	0 0	-18.5 -18.5 0.08 (4)	10.00
AF-AG	0 0	-18.5 -18.5 0.08 (4)	10.00
AG-R	0 0	-18.5 -18.5 0.08 (4)	10.00
R-AH	0 4024	-18.5 -18.5 0.31 (1)	10.00
AH-AI	0 4024	-18.5 -18.5 0.31 (1)	10.00
AI-O	0 4024	-18.5 -18.5 0.31 (1)	10.00
O-AJ	0 7102	-18.5 -18.5 0.52 (1)	10.00
AJ-P	0 7102	-18.5 -18.5 0.52 (1)	10.00
P-AK	0 7102	-18.5 -18.5 0.52 (1)	10.00
AK-AL	0 7102	-18.5 -18.5 0.52 (1)	10.00
AL-O	0 7070	-18.5 -18.5 0.52 (1)	10.00
O-AM	0 7070	-18.5 -18.5 0.52 (1)	10.00
AM-N	0 7070	-18.5 -18.5 0.52 (1)	10.00
N-AN	0 7070	-18.5 -18.5 0.52 (1)	10.00
AN-M	0 7070	-18.5 -18.5 0.52 (1)	10.00
M-AO	0 3960	-18.5 -18.5 0.30 (1)	10.00
AO-AP	0 3960	-18.5 -18.5 0.30 (1)	10.00
AP-AQ	0 3960	-18.5 -18.5 0.30 (1)	10.00
AQ-L	0 3960	-18.5 -18.5 0.30 (1)	10.00

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
 GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
 LOADS WERE DERIVED FROM USER INPUT
 NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	DL	PSF
TOP CH.	LL	25.6	PSF
BOT CH.	LL	6.0	PSF
BOT CH.	LL	0.0	PSF
BOT CH.	LL	7.4	PSF
TOTAL LOAD		39.0	PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***
 ADDTL. USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 PART 9 OF NBCC 2010, DEC 2012, ABC 2019
 PART 9 OF CBC 2012 (2019 AMENDMENT)
 CSA 086-09, CSA 086-14
 TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD
 EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.20")
 ALLOWABLE DEFL.(TL) = L/380 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.37")

CSI: TC=0.33/1.00 (E-G:1), BC=0.52/1.00 (O-Q:1),
 WB=0.51/1.00 (B-R:1), SS=0.18/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR SECTION (PSI)	(PL)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667	785

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (Q); INPUT = 0.90
 JSI METAL= 0.68 (P); INPUT = 1.00

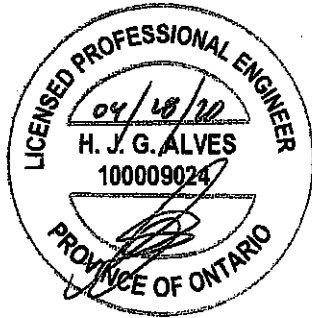

Structural component only
 DWG# T-2007632 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T20	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:02 2020 Page 2
ID:DMCubNVR6TstF0831vbl zns1l-x73EqNd7XbU6sscoDbPaw0PaBNFZ7YIB c8zMEMh

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	6.0	1.75	2.75
C	TTWW-m	MT20	6.0	9.0	2.75	3.50
D	TMWV-w	MT20	5.0	6.0		
E	TS-t	MT20	3.0	6.0		
F	TMWV-t	MT20	5.0	6.0		
G	TMWV-m	MT20	6.0	9.0	2.75	3.50
H	TMWV-p	MT20	5.0	6.0	1.75	2.75
I	BMV1-p	MT20	3.0	6.0		
K	BMWV-t	MT20	5.0	6.0	2.50	2.75
L	BMWV-t	MT20	5.0	6.0		
M	BS-t	MT20	5.0	6.0		
N	BS-t	MT20	5.0	6.0		
O	BMWV-t	MT20	5.0	6.0		
P	BS-t	MT20	5.0	6.0		
Q	BMWV-t	MT20	5.0	6.0		
R	BMWV-t	MT20	5.0	6.0	2.50	2.75
S	BMV1-p	MT20	3.0	6.0		

LOADING

TOTAL LOAD CASES: (4)


CHORDS				WEBS			
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. FACTORED CS (LC)	MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. FACTORED CS (LC)
FR-TO		FROM TO		FR-TO		FROM TO	
L-AR	0 0	-18.5 -18.5 0.08 (4)	10.00				
AR-AS	0 0	-18.5 -18.5 0.08 (4)	10.00				
AS-K	0 0	-18.5 -18.5 0.08 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-10-0	-60	-67	---	FRONT	VERT	DEAD	---	C1
C	4-10-0	-311	-311	---	FRONT	VERT	SNOW	---	C1
D	11-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	30-4-0	-60	-67	---	FRONT	VERT	DEAD	---	C1
H	30-4-0	-311	-311	---	FRONT	VERT	SNOW	---	C1
N	21-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Q	11-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
R	5-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	5-2-12	-138	-138	---	FRONT	VERT	TOTAL	---	C1
U	7-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	9-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	13-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	15-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	17-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	19-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	29-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	1-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	3-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	7-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	9-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	13-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	15-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AL	17-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AM	19-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AN	23-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	25-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AP	27-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AQ	29-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AR	31-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AS	33-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

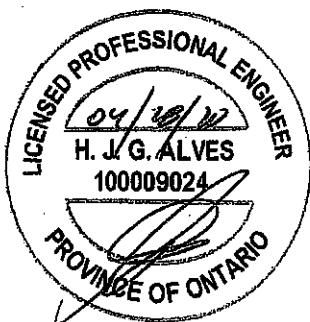

Structural component only
DWG# T-2007632

JOB NAME 408223	TRUSS NAME T21	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:03 2020 Page 1	
ID:DMCubINVR6TstFoe31v6I zns11-PKdcjelUqilK0D3AWqxoT6J Wk xSi yx9bzmEMg				35-0 36-5-8	
-1-3-8 0-0 1-3-8 3-4-9 3-2-1 6-6-9 5-6-13 12-1-7 5-5-9 17-7-0 5-5-9 23-0-9 5-6-13 28-7-7 3-2-1 3-4-9 35-0 36-5-8				Scale = 1:57.6	

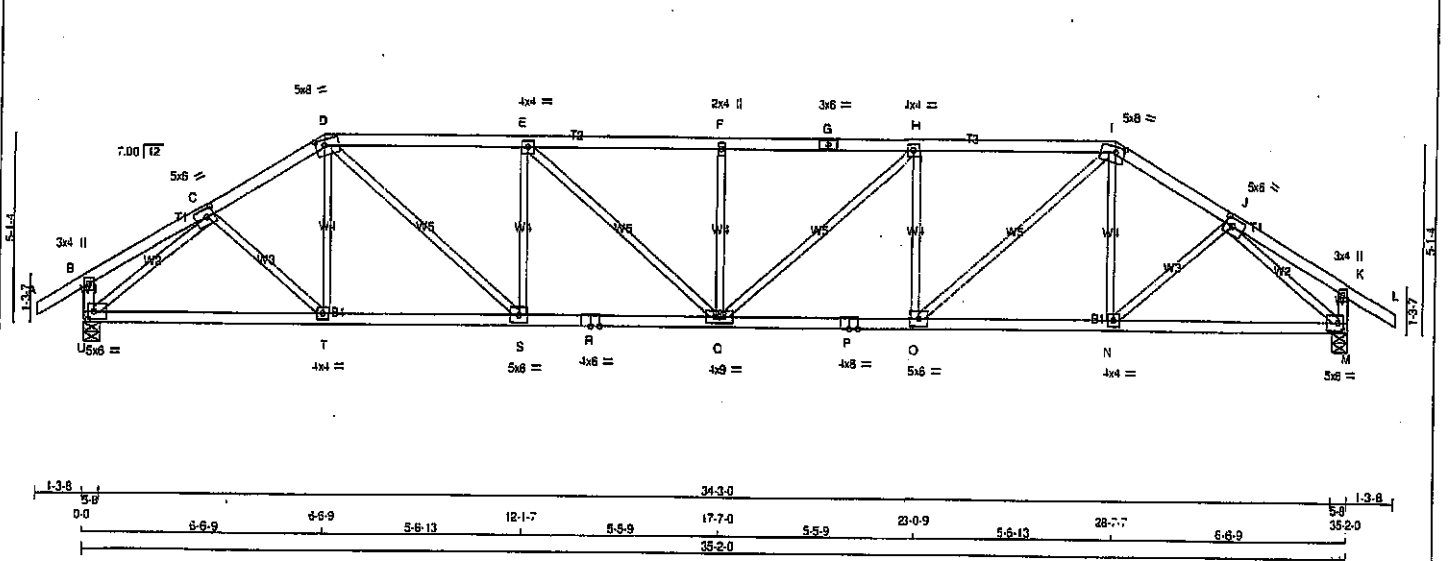

LUMBER			
N. L. G. A. RULES	SIZE	DRY	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
U - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMV+p	MT20	3.0	4.0	
C TMWW-t	MT20	5.0	8.0	2.50 2.50
D TTWW-m	MT20	5.0	8.0	1.75 3.00
E TMWW-t	MT20	4.0	4.0	
F TMW+w	MT20	2.0	4.0	
G TS-t	MT20	3.0	6.0	
H TMWW-t	MT20	4.0	4.0	
I TTWW-m	MT20	5.0	8.0	1.75 3.00
J TMWW-t	MT20	5.0	6.0	2.50 2.50
K TMV+p	MT20	3.0	4.0	
M BMWW-t	MT20	5.0	6.0	2.50 2.00
N BMWW-t	MT20	4.0	4.0	
O BMWW-t	MT20	5.0	6.0	
P BS-t	MT20	4.0	6.0	
Q BMWW-t	MT20	4.0	9.0	
R BS-t	MT20	4.0	6.0	
S BMWW-t	MT20	5.0	6.0	
T BMWW-t	MT20	4.0	4.0	
U BMWW-t	MT20	5.0	6.0	2.50 2.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	GROSS REACTION	GROSS REACTION	DOWN	UP	BRG
U	2064	0	2064	0	5-8
M	2064	0	2064	0	5-8

UNFACTORED REACTIONS		1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
U	1457	970	0
M	1457	970	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.12 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (PLF)	MEMB.	FORCE (LBS)
FR-TO				FR-TO	
A-B	0 32	-91.8	-91.8 0.12 (1)	C-T	0 213
B-C	0 13	-91.8	-91.8 0.12 (1)	D-S	-8 69
C-D	-2527 0	-91.8	-91.8 0.20 (1)	E-S	0 1447
D-E	-3264 0	-91.8	-91.8 0.66 (1)	F-S	-853 0
E-F	-3585 0	-91.8	-91.8 0.70 (1)	G-O	0 428
F-G	-3585 0	-91.8	-91.8 0.70 (1)	H-O	-482 0
G-H	-3585 0	-91.8	-91.8 0.70 (1)	I-H	0 428
H-I	-3264 0	-91.8	-91.8 0.66 (1)	J-I	0 1447
I-J	-2527 0	-91.8	-91.8 0.20 (1)	K-I	-8 69
J-K	0 13	-91.8	-91.8 0.12 (1)	L-I	0 213
K-L	0 32	-91.8	-91.8 0.12 (1)	M-I	-8 69
L-M	-249 0	0.0	0.0 0.03 (1)	N-I	0 213
M-N	-249 0	0.0	0.0 0.03 (1)	O-I	-853 0
U-T	0 2005	-18.5	-18.5 0.42 (1)	J-M	-2671 0
T-S	0 2167	-18.5	-18.5 0.44 (1)		
S-R	0 3264	-18.5	-18.5 0.58 (1)		
R-Q	0 3264	-18.5	-18.5 0.58 (1)		
Q-P	0 3264	-18.5	-18.5 0.58 (1)		
P-O	0 3264	-18.5	-18.5 0.58 (1)		
O-N	0 2167	-18.5	-18.5 0.44 (1)		
N-M	0 2005	-18.5	-18.5 0.42 (1)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CSI: TC=0.70/1.00 (E-F:1), BC=0.58/1.00 (G-S:1), WB=0.82/1.00 (J-M:1), SS=0.24/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 798 1987 1668

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (M) (INPUT = 0.90)
JSI METAL = 0.74 (R) (INPUT = 1.00)



Structural component only
DWG# T-2007633


JOB NAME 408223	TRUSS NAME T22	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:04:04 2020 Page 1	
1-3.8 0-0 4-2.13 4-2.13 4-0.5 3-3.2 6-3-0 14-6-2 6-1-12 20-7-14 4-3-0 26-10-14 4-0-5 30-11-3 4-2-13 1-3.8 13-8 35-2-0 35-5-8 Scale = 1:57.6				ID:DMCubINVR6TstFoe31v8I zns11-tWB743eNF8rCMAoFjDG3U?0GFOHjTrCag4h1zMEMf 20-7-14 26-10-14 4-0-5 30-11-3 4-2-13 1-3.8	

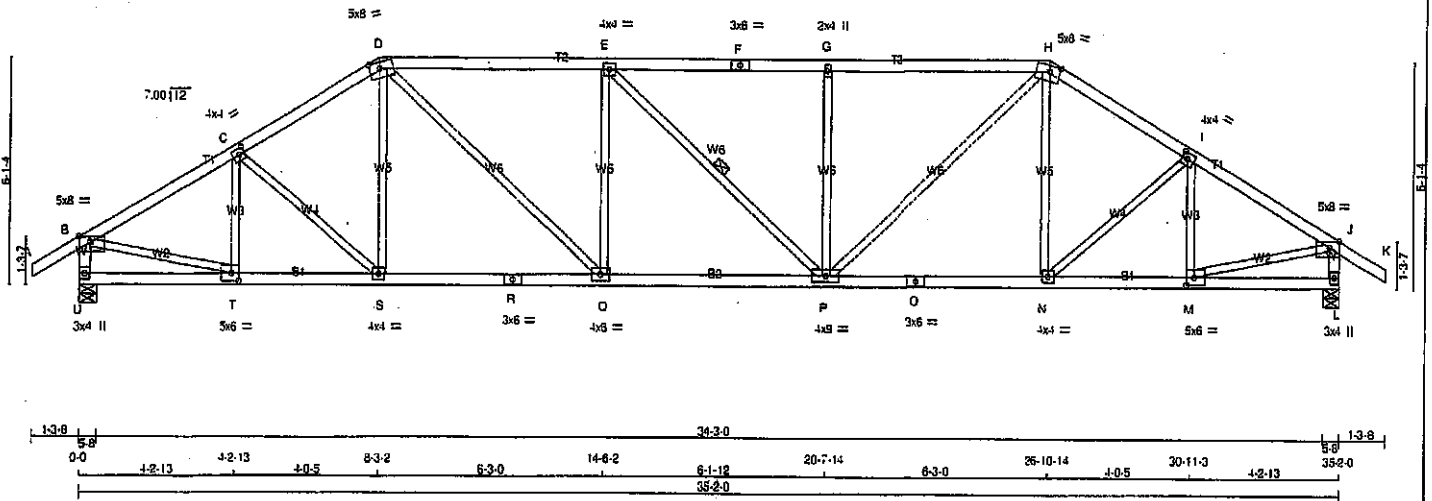

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES				BEARINGS				SPECIFIED LOADS:			
CHORDS	SIZE	LUMBER	DESCR.	FACTORED	MAXIMUM FACTORED	INPUT	REQD	TOP CH. LL = 25.6 PSF			
A - D	2x4	DRY No.2	SPF	GROSS REACTION	GROSS REACTION	BRG	BRG	DL = 6.0 PSF			
E - H	2x4	DRY No.2	SPF	VERT	DOWN	UPLIFT	IN-SX	BOT CH. LL = 0.0 PSF			
I - K	2x4	DRY No.2	SPF	U	2064	0	5-8	DL = 7.4 PSF			
L - J	2x4	DRY No.2	SPF	L	2064	0	5-8	TOTAL LOAD = 39.0 PSF			
K - O	2x4	DRY No.2	SPF	UNFACTORED REACTIONS				SPACING = 24.0 IN. C/C			
U - B	2x4	DRY No.2	SPF	1ST LCASE				LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12			
L - J	2x4	DRY No.2	SPF	MAX. MIN. COMPONENT REACTIONS				THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015			
U - R	2x4	DRY No.2	SPF	COMBINED				THIS DESIGN COMPLIES WITH:			
R - O	2x4	DRY No.2	SPF	SNOW				- PART 9 OF NBCC 2018, CBC 2012, ABC 2019			
O - L	2x4	DRY No.2	SPF	LIVE				- PART 9 OF CBC 2012 (2019 AMENDMENT)			
ALL WEBS	2x3	DRY No.2	SPF	PERM. LIVE				- CSA 086-08, CSA 088-14			
EXCEPT				WIND				- TPIC 2011, TPIC 2014			
				DEAD				155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD			
				SOIL				ALLOWABLE DEFL.(LL) = L/360 (1.17")			
								CALCULATED VERT. DEFL.(LL) = L/999 (0.16")			
								ALLOWABLE DEFL.(TL) = L/360 (1.17")			
								CALCULATED VERT. DEFL.(TL) = L/999 (0.30")			
								CSL: TC=0.75:1.00 (D-E:1), BC=0.54:1.00 (P-Q:1), WB=0.50:1.00 (B-T:1), SS=0.27:1.00 (D-E:1)			
								DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10			
								COMP=1.10 SHEAR=1.10 TENS=1.10			
								COMPANION LIVE LOAD FACTOR = 1.00			
								TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.			
								NAIL VALUES			
								PLATE GRIP(DRY) SHEAR SECTION			
								(PSI) (PLI) (PLI)			
								MAX MIN MAX MIN MAX MIN			
								MT20 618 354 1667 788 1987 1656			
								PLATE PLACEMENT TOL. = 0.250 inches			
								PLATE ROTATION TOL. = 5.0 Deg.			
								JSI GRIP = 0.89 (TI) (INPUT = 0.90)			
								JSI METAL = 0.70 (OI) (INPUT = 1.00)			

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	Edge	3.50
C TMVW-l	MT20	4.0	4.0	2.00	1.75
D TTWW-m	MT20	5.0	8.0	2.00	3.50
E TMVW-t	MT20	4.0	4.0		
F TS-l	MT20	3.0	6.0		
G TMVW-w	MT20	2.0	4.0		
H TTWW-m	MT20	5.0	8.0	2.00	3.50
I TMVW-t	MT20	4.0	4.0	2.00	1.75
J TMVW-p	MT20	5.0	8.0	Edge	3.50
L BMV1-p	MT20	3.0	4.0		
M BMVW-l	MT20	5.0	6.0	2.50	2.50
N BMVW-l	MT20	4.0	4.0		
O BS-l	MT20	3.0	6.0		
P BMVW-w	MT20	4.0	9.0		
Q BMVW-l	MT20	4.0	6.0		
R BS-l	MT20	3.0	6.0		
S BMVW-l	MT20	4.0	4.0		
T BMVW-t	MT20	5.0	6.0	2.50	2.50
U BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

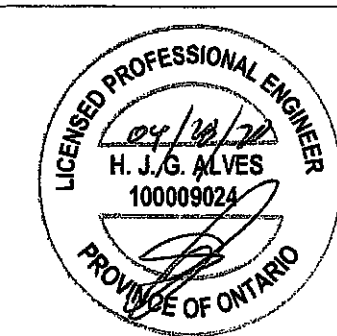


Structural component only
DWG# T-2007634

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T23	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:06 2020 Page 1
ID:DMCubINVR6TstFoe31v6t zns11-pvJiVkgeml5wbUyeretXZQ5aqCaV6JG8gw9BvzMEmd

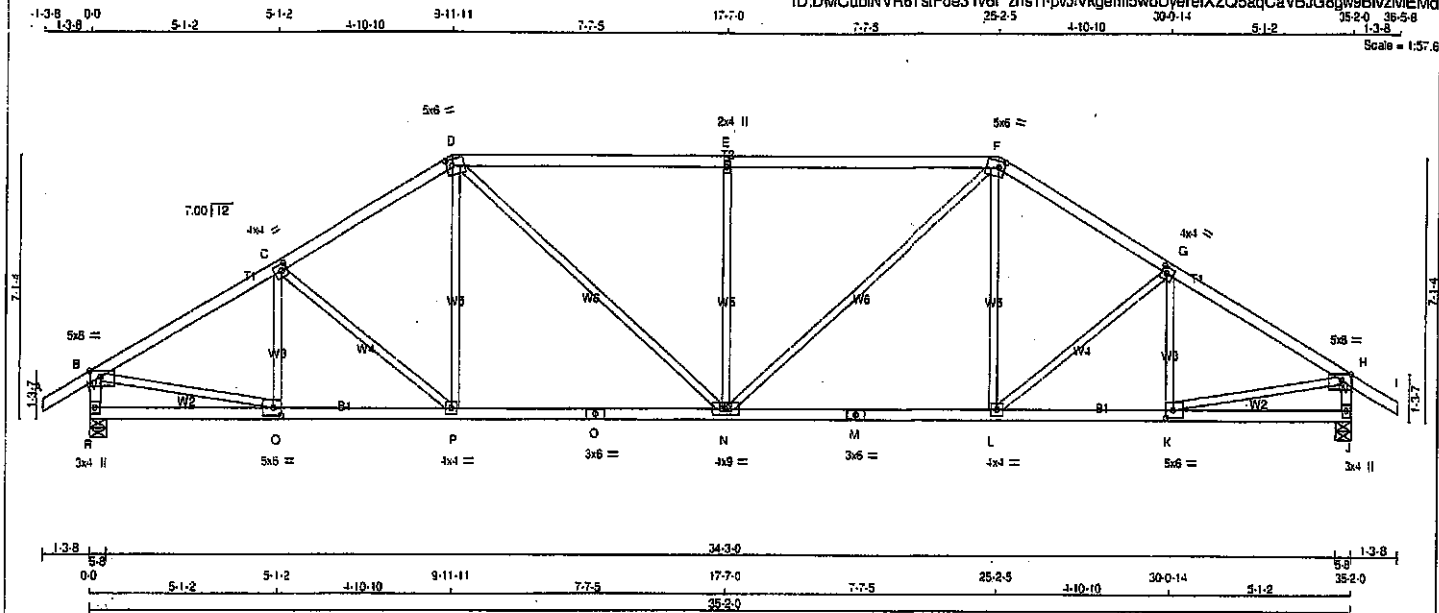

TOTAL WEIGHT = 145 lb

LUMBER					DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							TOTAL WEIGHT = 145 LB	
N. L. G. A. RULES					BEARINGS							[M] [F]	
CHORDS SIZE												DESIGN CRITERIA	
A - D	2x4	DRY	No.2	SPF	FACTORED		MAXIMUM FACTORED		INPUT	RECORD	SPECIFIED LOADS:		
D - F	2x4	DRY	No.2	SPF	GROSS REACTION		GROSS REACTION		BRG	BRG	TOP CH. LL = 25.6 PSF		
F - I	2x4	DRY	No.2	SPF	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	DL = 6.0 PSF
R - B	2x4	DRY	No.2	SPF	R	2064	0	2064	0	0	5-8	5-8	BOT CH. LL = 0.0 PSF
J - H	2x4	DRY	No.2	SPF	J	2064	0	2064	0	0	5-8	5-8	DL = 7.4 PSF
R - O	2x4	DRY	No.2	SPF	UNFACTORED REACTIONS							TOTAL LOAD = 39.0 PSF	
O - M	2x4	DRY	No.2	SPF	1ST LCASE							SPACING = 24.0 IN. C/C	
M - J	2x4	DRY	No.2	SPF	MAX. MIN. COMPONENT REACTIONS								
ALL WEBS 2x3 DRY No.2 SPF					JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.0:12
EXCEPT					R	1457	970.0	0.0	0.0	0.0	488.0	0.0	
DRY: SEASONED LUMBER.					J	1457	970.0	0.0	0.0	0.0	488.0	0.0	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
A	TMVW-i	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	6.0	2.00	2.00
E	TMVW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.00	2.00
G	TMVW-i	MT20	4.0	4.0	2.00	1.75
H	TMVW-p	MT20	5.0	8.0	Edge	3.50
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-i	MT20	5.0	6.0	2.50	2.50
L	BMVW-i	MT20	4.0	4.0		
M	BS-i	MT20	3.0	6.0		
N	BMVW-i	MT20	4.0	4.0		
O	BS-i	MT20	3.0	6.0		
P	BMVW-i	MT20	4.0	4.0		
Q	BMVW-i	MT20	5.0	6.0	2.50	2.50
R	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.16 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 32	-91.8 -91.8 0.12 (1)	10.00	Q-C	-335 0	0.09 (1)	
B-C	-2537 0	-91.8 -91.8 0.39 (1)	4.00	C-P	-216 0	0.16 (1)	
C-D	-2386 0	-91.8 -91.8 0.37 (1)	4.11	P-D	0 256	0.06 (4)	
D-E	-2609 0	-91.8 -91.8 0.88 (1)	3.16	D-N	0 752	0.17 (1)	
E-F	-2609 0	-91.8 -91.8 0.88 (1)	3.16	N-E	-860 0	0.75 (1)	
F-G	-2386 0	-91.8 -91.8 0.37 (1)	4.11	N-F	0 752	0.17 (1)	
G-H	-2537 0	-91.8 -91.8 0.39 (1)	4.00	L-F	0 256	0.06 (4)	
H-I	0 32	-91.8 -91.8 0.12 (1)	10.00	L-G	-216 0	0.16 (1)	
R-B	-2020 0	0.0 0.0 0.21 (1)	5.94	K-G	-335 0	0.09 (1)	
J-H	-2020 0	0.0 0.0 0.21 (1)	5.94	S-Q	0 2253	0.51 (1)	
				K-H	0 2253	0.51 (1)	
R-O	0 0	-18.5 -18.5 0.10 (4)	10.00				
Q-P	0 2213	-18.5 -18.5 0.45 (1)	10.00				
P-O	0 2048	-18.5 -18.5 0.44 (1)	10.00				
O-N	0 2048	-18.5 -18.5 0.44 (1)	10.00				
N-M	0 2048	-18.5 -18.5 0.44 (1)	10.00				
M-L	0 2048	-18.5 -18.5 0.44 (1)	10.00				
L-K	0 2213	-18.5 -18.5 0.45 (1)	10.00				
K-J	0 0	-18.5 -18.5 0.10 (4)	10.00				

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

ISS % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.13")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.27")

CSI: TC=0.88(1.00 (E-F:1), BC=0.45(1.00 (K-L:1), WG=0.75(1.00 (E-N:1), SS=0.34(1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1997 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.88 (K) (INPUT = 0.90)
JSI METAL = 0.72 (M) (INPUT = 1.00)

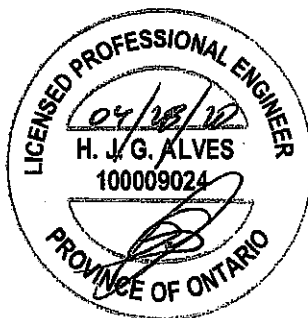

Structural component only
DWG# T-2007635

JOB NAME 408223	TRUSS NAME T24	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:07 2020 Page 1
ID:DMCubINVR6TsIFoe31v61_zns11-H5s74hGX3DnDeWqPLom6espobw_wk9HuavkIMzMEMc
352-0 36-5-8
Scale = 1:57.6

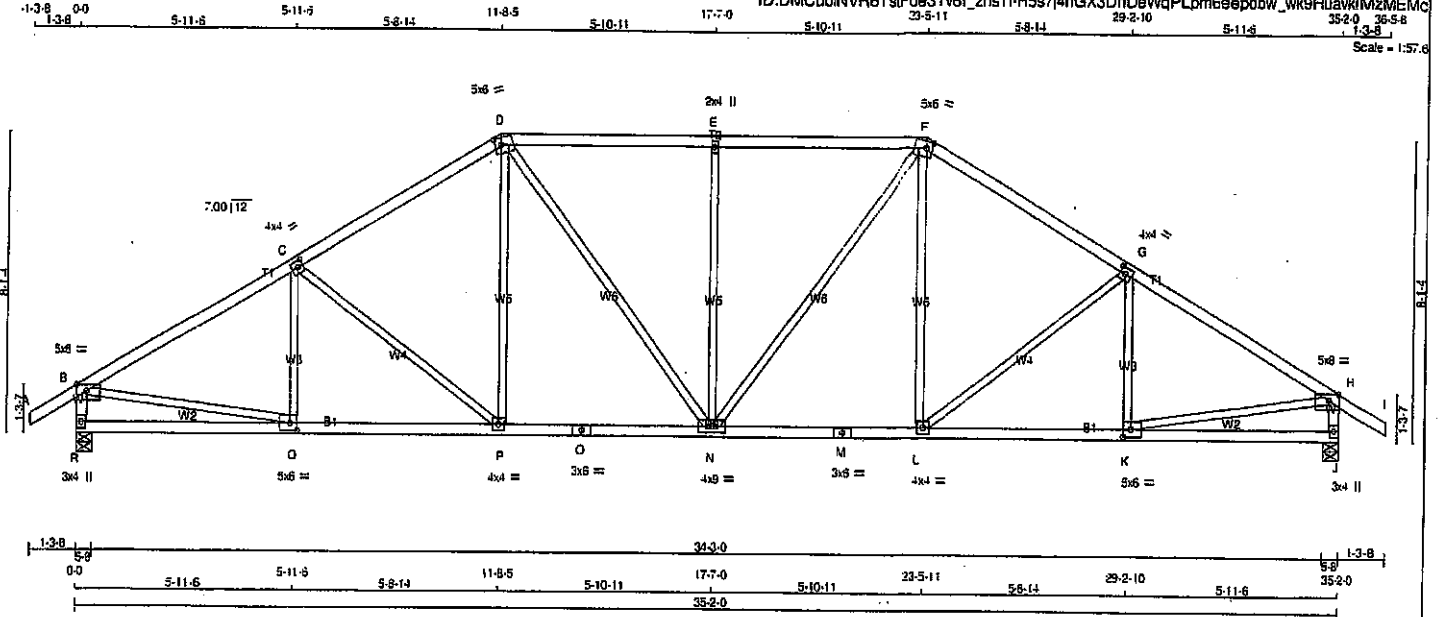

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMVW-p	MT20	5.0	8.0	Edge 3.50
C TMWW-l	MT20	4.0	4.0	2.00 1.75
D TTWW-m	MT20	5.0	6.0	2.25 2.00
E TMW-w	MT20	2.0	4.0	
F TTWW-m	MT20	5.0	6.0	2.25 2.00
G TMWW-l	MT20	4.0	4.0	2.00 1.75
H TMVW-p	MT20	5.0	8.0	Edge 3.50
J BMV1+p	MT20	3.0	4.0	
K BMWW-l	MT20	5.0	6.0	2.50 2.50
L BMWW-l	MT20	4.0	4.0	
M BS-l	MT20	3.0	6.0	
N BMWW-l	MT20	4.0	9.0	
O BS-l	MT20	3.0	6.0	
P BMWW-l	MT20	4.0	4.0	
Q BMWW-l	MT20	5.0	6.0	2.50 2.50
R BMV1+p	MT20	3.0	4.0	


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
JT	FACTORED GROSS REACTION VERT	FACTORED GROSS REACTION DOWN	FACTORED GROSS REACTION UP	FACTORED GROSS REACTION HORZ	FACTORED GROSS REACTION HORZ	FACTORED GROSS REACTION UPLIFT	FACTORED GROSS REACTION IN-SX	FACTORED GROSS REACTION IN-SX	FACTORED GROSS REACTION IN-SX
R	2064	0	2064	0	0	0	5-8	5-8	5-8
J	2064	0	2064	0	0	0	5-8	5-8	5-8
UNFACTORED REACTIONS									
JT	1ST LCASE	2ND LCASE	3RD LCASE	4TH LCASE	5TH LCASE	6TH LCASE	7TH LCASE	8TH LCASE	9TH LCASE
R	1457	970	0	0	0	0	0	0	0
J	1457	970	0	0	0	0	0	0	0
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.81 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.									
LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 (LC)	MAX. FACTORED UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LC1 (LC)	MAX. FACTORED UNBRAC LENGTH	MEMB.
R-B	0	32	-91.8	-91.8 0.12 (1)	10.00	Q-C	-252	12	0.08 (1)
B-C	-2575	0	-91.8	-91.8 0.54 (1)	3.81	C-P	-388	0	0.31 (1)
C-D	-2283	0	-91.8	-91.8 0.50 (1)	4.05	P-D	0	345	0.08 (1)
D-E	-2236	0	-91.8	-91.8 0.49 (1)	4.06	D-N	0	480	0.11 (1)
E-F	-2236	0	-91.8	-91.8 0.49 (1)	4.06	N-E	-662	0	0.84 (1)
F-G	-2283	0	-91.8	-91.8 0.54 (1)	4.05	N-F	0	480	0.11 (1)
G-H	-2575	0	-91.8	-91.8 0.54 (1)	3.81	F-G	0	345	0.08 (1)
H-I	0	32	-91.8	-91.8 0.12 (1)	10.00	L-G	-388	0	0.41 (1)
R-B	-2016	0	0.0	0.0 0.21 (1)	5.94	K-G	-252	12	0.08 (1)
J-H	-2016	0	0.0	0.0 0.21 (1)	5.94	B-Q	0	2281	0.51 (1)
R-Q	0	0	-18.5	-18.5 0.14 (4)	10.00	K-H	0	2281	0.51 (1)
Q-P	0	2251	-18.5	-18.5 0.43 (1)	10.00				
P-O	0	1947	-18.5	-18.5 0.38 (1)	10.00				
O-N	0	1947	-18.5	-18.5 0.38 (1)	10.00				
N-M	0	1947	-18.5	-18.5 0.38 (1)	10.00				
M-L	0	1947	-18.5	-18.5 0.38 (1)	10.00				
L-K	0	2251	-18.5	-18.5 0.43 (1)	10.00				
K-J	0	0	-18.5	-18.5 0.14 (4)	10.00				

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
OL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
OL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF
SPACING = 24.0 IN. C/C	
LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12	
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015	
THIS DESIGN COMPLIES WITH:	
- PART 9 OF CBC 2018, CBC 2012, ABC 2019	
- PART 9 OF CBC 2012 (2019 AMENDMENT)	
- CSA 086-09, CSA 086-14	
- TPIC 2011, TPIC 2014	
65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD	
ALLOWABLE DEFL.(LL) = L/360 (1.17")	
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")	
ALLOWABLE DEFL.(TL) = L/360 (1.17")	
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")	
CSI: TC=0.54(1.00 (B-C:1) . BC=0.43(1.00 (P-Q:1) . WB=0.84(1.00 (E-N:1) . SS=0.26(1.00 (D-E:1)	
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10	
COMPANION LIVE LOAD FACTOR = 1.00	
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.	
NAIL VALUES	
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)	
MAX MIN MAX MIN MAX MIN	
MT20 618 354 1667 788 1987 1656	
PLATE PLACEMENT TOL. = 0.250 inches	
PLATE ROTATION TOL. = 5.0 Deg.	
JSI GRIP= 0.88 (Q) (INPUT = 0.90)	
JSI METAL= 0.61 (M) (INPUT = 1.00)	



Structural component only
DWG# T-2007636

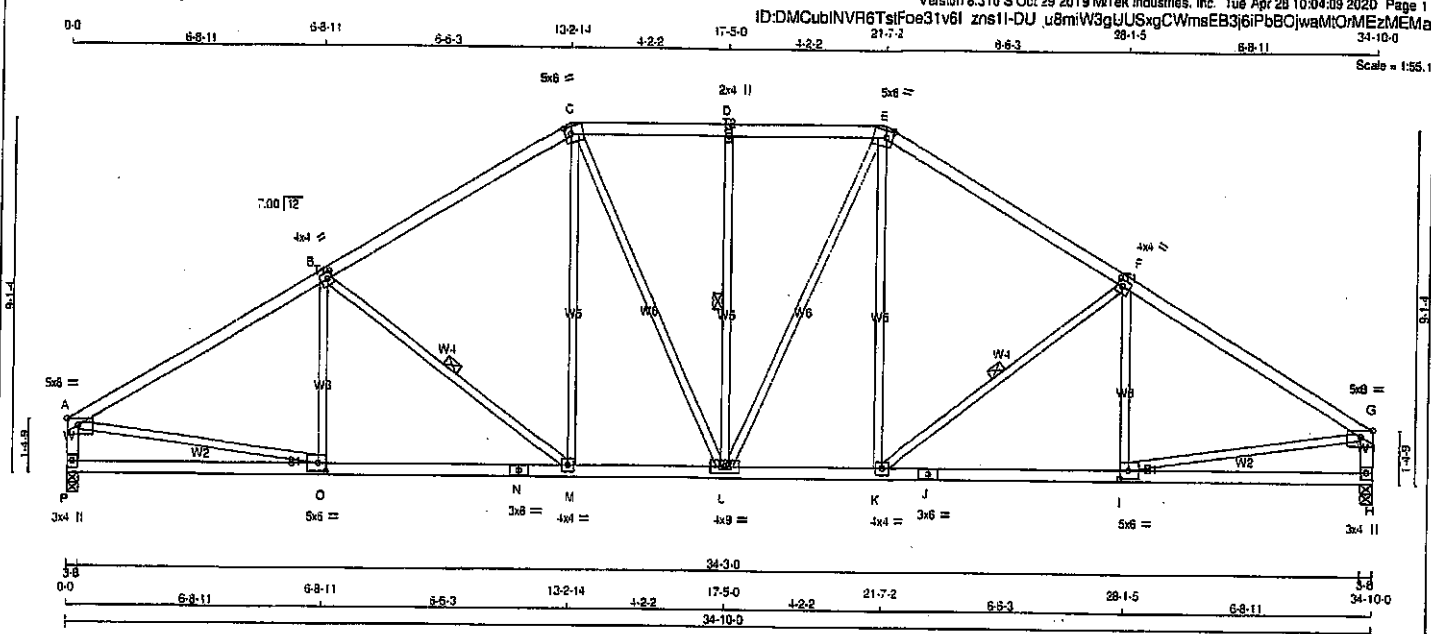

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
O - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
P - A	2x4	DRY	No.2
H - G	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y
A	TMVW-p	MT20	5.0	8.0	2.00 Edge
B	TMVW-t	MT20	4.0	4.0	2.00 1.75
C	TTWW-m	MT20	5.0	6.0	2.25 2.00
D	TMVW-w	MT20	2.0	4.0	
E	TTWW-m	MT20	5.0	6.0	2.25 2.00
F	TMVW-t	MT20	4.0	4.0	2.00 1.75
G	TMVW-p	MT20	5.0	8.0	Edge 3.50
H	BMV1-p	MT20	3.0	4.0	
I	BMVW-t	MT20	5.0	6.0	2.50 2.50
J	BS-t	MT20	3.0	6.0	
K	BMVW-t	MT20	4.0	4.0	
L	BMVW-w	MT20	4.0	9.0	
M	BMVW-t	MT20	4.0	4.0	
N	BS-t	MT20	3.0	6.0	
O	BMVW-t	MT20	5.0	6.0	2.50 2.50
P	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED	MAXIMUM FACTORED		INPUT	REQD
	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
JT	VERT	HORZ	HORZ	UPLIFT	IN-SX
P	1920	0	1920	0	3-8
H	1920	0	1920	0	3-8

UNFACTORED REACTIONS					
	1ST LCASE	MAX. MIN. COMPONENT REACTIONS		WIND	DEAD
JT	COMBINED	SNOW	LIVE	PERM. LIVE	SOIL
P	1358	891	0	0	0
H	1358	891	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.54 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1:2 LENGTH OF B-M, D-L, F-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.		MAX. FACTORED	FACTORED		MEMB.		MAX. FACTORED			
FR-TO	(LBS)	VERT. LOAD	CS (LC)	MAX. UNBRAC	FR-TO	(LBS)	MAX. CS (LC)			
FR-TO		FROM TO		LENGTH	FR-TO					
A-B	-2510	0	-91.8	-91.8	0.71 (1)	3.64	O-B	-212	40	0.09 (1)
B-C	-2113	0	-91.8	-91.8	0.63 (1)	3.99	B-M	-510	0	0.24 (1)
C-D	-1919	0	-91.8	-91.8	0.24 (1)	4.64	M-C	0	412	0.09 (1)
D-E	-1919	0	-91.8	-91.8	0.24 (1)	4.64	C-L	0	287	0.05 (1)
E-F	-2113	0	-91.8	-91.8	0.63 (1)	3.99	L-D	-461	0	0.25 (1)
F-G	-2510	0	-91.8	-91.8	0.71 (1)	3.64	E-L	0	287	0.06 (1)
P-A	-1858	0	0.0	0.0	0.19 (1)	6.13	K-E	0	412	0.09 (1)
H-G	-1858	0	0.0	0.0	0.19 (1)	6.13	K-F	-510	0	0.24 (1)
							I-F	-212	40	0.09 (1)
P-O	0	0	-18.5	-18.5	0.20 (4)	10.00	A-O	0	2227	0.50 (1)
O-N	0	2199	-18.5	-18.5	0.45 (1)	10.00	I-G	0	2227	0.50 (1)
N-M	0	2199	-18.5	-18.5	0.45 (1)	10.00				
M-L	0	1797	-18.5	-18.5	0.35 (1)	10.00				
L-K	0	1797	-18.5	-18.5	0.35 (1)	10.00				
K-J	0	2199	-18.5	-18.5	0.45 (1)	10.00				
J-I	0	2199	-18.5	-18.5	0.45 (1)	10.00				
I-H	0	0	-18.5	-18.5	0.20 (4)	10.00				

TOTAL WEIGHT = 3 X 154 = 482 lb

DESIGN CRITERIA	
TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF
SPACING = 24.0 IN. C/C	

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.16")
CALCULATED VERT. DEFL. (LL) = L/999 (0.11")
ALLOWABLE DEFL. (TL) = L/360 (1.16")
CALCULATED VERT. DEFL. (TL) = L/999 (0.21")

CSI: TC=0.71 1.00 (A-B:1), BC=0.45 1.00 (M-O:1), WB=0.50 1.00 (A-O:1), SS=0.26 1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	818	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.84 (I) (INPUT = 0.90)



JSI METAL = 0.56 (N) (INPUT = 1.00)



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T28	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 10:04:10 2020 Page 1
ID:DMCubINVR8tstFoe31v6t zns1l-igYGL6j8a cl45FP4UNTkGGKpt777_kbX7PuhzMEMZ

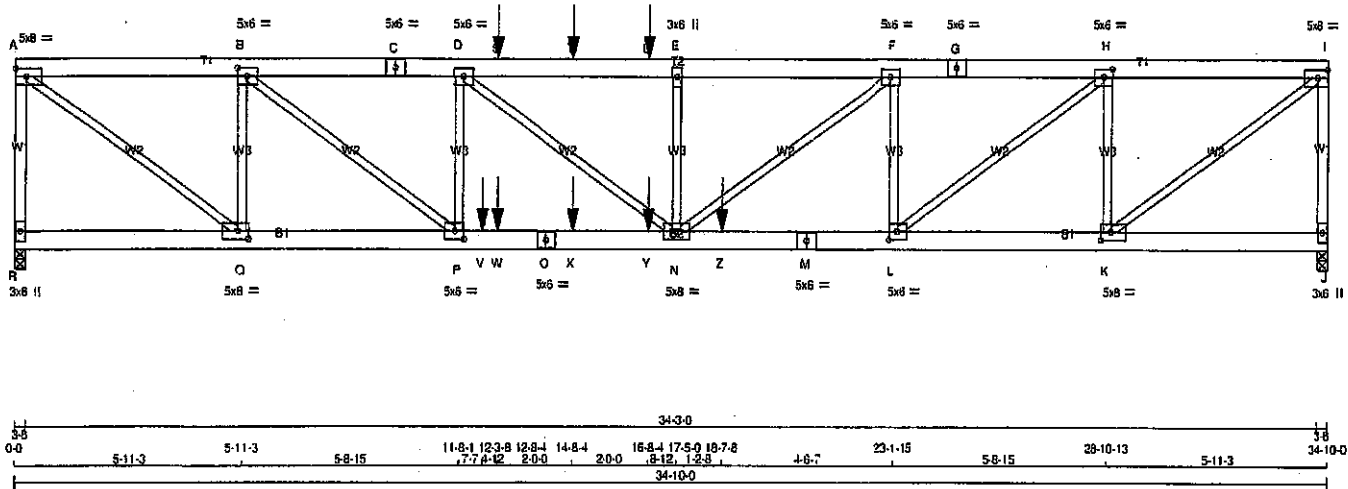

TOTAL WEIGHT = 2 X 183 = 366 lb

LUMBER	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES				
CHORDS				
R - A	2x4	DRY	No.2	SPF
A - C	2x6	DRY	No.2	SPF
C - G	2x6	DRY	No.2	SPF
G - I	2x6	DRY	No.2	SPF
I - J	2x4	DRY	No.2	SPF
J - O	2x6	DRY	No.2	SPF
O - M	2x6	DRY	No.2	SPF
M - J	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122'X3') SPIRAL NAILS		
R - A	12	TOP
I - J	12	TOP
A - C	12	TOP
C - G	12	SIDE(0.0)
G - I	12	TOP
BOTTOM CHORDS : (0.122'X3') SPIRAL NAILS		
R - O	12	SIDE(0.0)
O - M	12	SIDE(0.0)
M - J	12	TOP
WEBS : (0.122'X3') SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	
	VERT	HORZ	DOWN	HORZ
	UPLIFT	IN-SX	IN-SX	
JT	3373	0	3373	0
R	3103	0	3103	0

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
	COMBINED	SNOW
	LIVE	PERM. LIVE
	WIND	DEAD
	SOIL	
JT	2380	1591
R	2190	1459

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1 MAX	CS1 (LC)	MAX. UNBRAC	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. (PLF)	FROM TO	LENGTH	FR-TO	MEMB.	FORCE (LBS)	MAX. CS1 (LC)
R-A	-3316	0	0.0	0.0	0.58 (1)	8.39	K-I	0 4719 0.58 (1)
A-B	-4149	0	-91.8	-91.8	0.14 (1)	5.47	A-Q	0 5171 0.84 (1)
B-C	-7288	0	-91.8	-91.8	0.20 (1)	4.33	K-H	-2757 0 0.44 (1)
C-D	-7288	0	-91.8	-91.8	0.20 (1)	4.33	Q-B	-2997 0 0.48 (1)
D-E	-8278	0	-91.8	-91.8	0.28 (1)	4.03	L-H	0 3530 0.44 (1)
E-F	-8278	0	-91.8	-91.8	0.28 (1)	4.03	P-F	0 3959 0.49 (1)
F-G	-8278	0	-91.8	-91.8	0.28 (1)	4.03	L-F	-1791 0 0.28 (1)
G-H	-8278	0	-91.8	-91.8	0.21 (1)	4.11	N-F	0 2134 0.26 (1)
H-I	-8278	0	-91.8	-91.8	0.19 (1)	4.52	D-N	0 1249 0.15 (1)
I-J	-3787	0	-91.8	-91.8	0.13 (1)	5.68	N-E	-673 0 0.11 (1)
J-K	-3042	0	0.0	0.0	0.51 (1)	6.62		
R-Q	0	0	-18.5	-18.5	0.04 (4)	10.00		
Q-P	0	4149	-18.5	-18.5	0.30 (1)	10.00		
P-V	0	7288	-18.5	-18.5	0.87 (1)	10.00		
V-W	0	7288	-18.5	-18.5	0.87 (1)	10.00		
W-O	0	7288	-18.5	-18.5	0.87 (1)	10.00		
O-X	0	7288	-18.5	-18.5	0.67 (1)	10.00		
X-Y	0	7288	-18.5	-18.5	0.87 (1)	10.00		
Y-N	0	7288	-18.5	-18.5	0.87 (1)	10.00		
N-Z	0	8586	-18.5	-18.5	0.72 (1)	10.00		
Z-M	0	8586	-18.5	-18.5	0.72 (1)	10.00		
M-L	0	8586	-18.5	-18.5	0.72 (1)	10.00		
L-K	0	3787	-18.5	-18.5	0.32 (1)	10.00		
K-J	0	0	-18.5	-18.5	0.04 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
JT	12-8-4	-88	-88	---	BACK	VERT	TOTAL	---	C1
S	14-8-4	-86	-86	---	BACK	VERT	TOTAL	---	C1
T	16-8-4	-86	-86	---	BACK	VERT	TOTAL	---	C1
U	12-3-8	-1052	-1052	---	BACK	VERT	TOTAL	---	C1
V	12-8-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
W	14-8-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
X	16-8-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
Y	18-8-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
Z	18-7-8	-1273	-1273	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.18")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/380 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CS1: TC=0.56(1.00) (A-R:1), BC=0.72(1.00) (L-N:1)
WB=0.84(1.00) (A-Q:1), SS1=0.37(1.00) (L-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 619 354 1667 788 1967 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (1) (INPUT = 0.90)
JSI METAL= 0.73 (4) (INPUT = 1.00)



Structural component only
DWG# T-2007639 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T28	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			


Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Tue Apr 28 10:04:10 2020 Page 2
ID:DMCubINVR6TstFoe3fv6l zns1l-igYGL68g cL45FP4UNTkGGKio777 kbX7PuhzMEMZ

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWW-I	MT20	5.0	8.0	2.50	3.25
B	TMWW-I	MT20	5.0	6.0	2.50	2.75
C	TS-I	MT20	5.0	6.0		
D	TMWW-I	MT20	5.0	6.0		
E	TMWW-w	MT20	3.0	6.0		
F	TMWW-I	MT20	5.0	6.0		
G	TS-I	MT20	5.0	6.0		
H	TMWW-I	MT20	5.0	6.0	2.50	2.75
I	TMWW-I	MT20	5.0	8.0	2.50	3.25
J	BMV1-p	MT20	3.0	6.0		
K	BMWW-I	MT20	5.0	8.0	2.50	3.25
L	BMWW-I	MT20	5.0	6.0	2.50	2.75
M	BS-I	MT20	5.0	6.0		
N	BMWW-I	MT20	5.0	6.0		
O	BS-I	MT20	5.0	6.0		
P	BMWW-I	MT20	5.0	6.0	2.50	2.75
Q	BMWW-I	MT20	5.0	8.0	2.50	3.25
R	BMV1-p	MT20	3.0	6.0		

CONNECTION REQUIREMENTS


11 C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

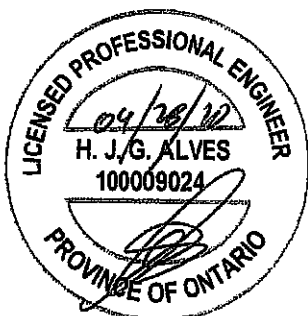

Structural component only
DWG# T-2007639 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T29	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:04:11 2020 Page 1
ID:DMCubINV6TstFoe31v6l zns11-As6eYSkmblkCfQbeBuiGUoUPDIsbAtp8tyR7zMEMY
23-2-4 28-11-8 34-10-0

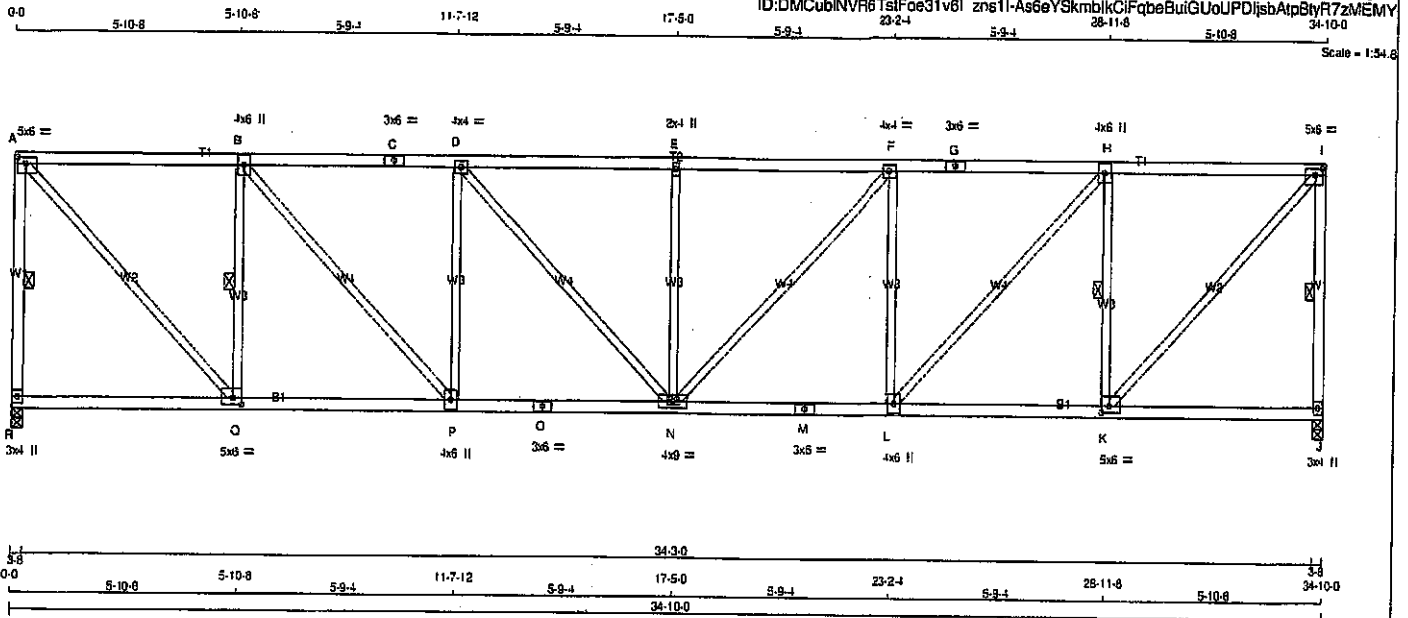

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
R - A	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
C - G	2x4	DRY	No.2	SPF	
G - I	2x4	DRY	No.2	SPF	
J - I	2x4	DRY	No.2	SPF	
R - O	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-I	MT20	5.0	6.0	2.00	2.50
B	TMVW-I	MT20	4.0	6.0		
C	TS-I	MT20	3.0	6.0		
D	TMVW-I	MT20	4.0	4.0		
E	TMVW-I	MT20	2.0	4.0		
F	TMVW-I	MT20	4.0	4.0		
G	TS-I	MT20	3.0	6.0		
H	TMVW-I	MT20	4.0	6.0		
I	TMVW-I	MT20	5.0	6.0	2.00	2.50
J	BMV1+p	MT20	3.0	4.0		
K	BMVW-I	MT20	5.0	6.0	2.00	2.50
L	BMVW-I	MT20	4.0	6.0		
M	BS-I	MT20	3.0	6.0		
N	BMVW-I	MT20	4.0	6.0		
O	BS-I	MT20	3.0	6.0		
P	BMVW-I	MT20	4.0	6.0		
Q	BMVW-I	MT20	5.0	6.0	2.00	2.50
R	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
R	1920	0	1920	0
J	1920	0	1920	0

UNFACTORED REACTIONS	1ST CASE	MAX.	MIN.	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE	PERM. LIVE
R	1358	891	0	0
J	1358	891	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-R, I-J, B-Q, H-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	UNBRACED LENGTH	FR-TO	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)
R-A	-1876	0	0.0	0.0	0.37 (1)	4.90	A-Q	0	2281	0.51 (1)
A-B	-1583	0	-91.8	-91.8	0.53 (1)	4.61	Q-B	-1540	0	0.43 (1)
B-C	-2426	0	-91.8	-91.8	0.63 (1)	3.77	B-P	0	1272	0.29 (1)
C-D	-2426	0	-91.8	-91.8	0.63 (1)	3.77	P-D	-831	0	0.58 (1)
D-E	-2725	0	-91.8	-91.8	0.56 (1)	3.72	D-N	0	440	0.10 (1)
E-F	-2725	0	-91.8	-91.8	0.56 (1)	3.72	N-E	-539	0	0.38 (1)
F-G	-2426	0	-91.8	-91.8	0.63 (1)	3.77	E-F	0	440	0.10 (1)
G-H	-2426	0	-91.8	-91.8	0.63 (1)	3.77	F-H	-831	0	0.58 (1)
H-I	-1583	0	-91.8	-91.8	0.53 (1)	4.61	I-F	0	1272	0.29 (1)
I-J	-1876	0	0.0	0.0	0.37 (1)	4.90	H-K	-1540	0	0.43 (1)
R-Q	0	0	-18.5	-18.5	0.15 (4)	10.00	K-I	0	2281	0.51 (1)
Q-P	0	1563	-18.5	-18.5	0.33 (1)	10.00				
P-O	0	2426	-18.5	-18.5	0.44 (1)	10.00				
O-N	0	2426	-18.5	-18.5	0.44 (1)	10.00				
N-M	0	2426	-18.5	-18.5	0.44 (1)	10.00				
M-L	0	2426	-18.5	-18.5	0.44 (1)	10.00				
L-K	0	1583	-18.5	-18.5	0.33 (1)	10.00				
K-J	0	0	-18.5	-18.5	0.15 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.16")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.31")

CS: TC=0.63(1.00 (F-H:1), BC=0.44(1.00 (N-P:1), WB=0.58(1.00 (F-L:1), SS=0.25(1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.87 (A) (INPUT = 0.90)
JSI METAL = 0.78 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007640

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T30	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:12 2020 Page 1
ID:DMCubINVR6TstFoe31v6t_zns1l-a3g0mokCmbs3JPPnBvPxpHb6cdJb?so2rcVzZMEMX

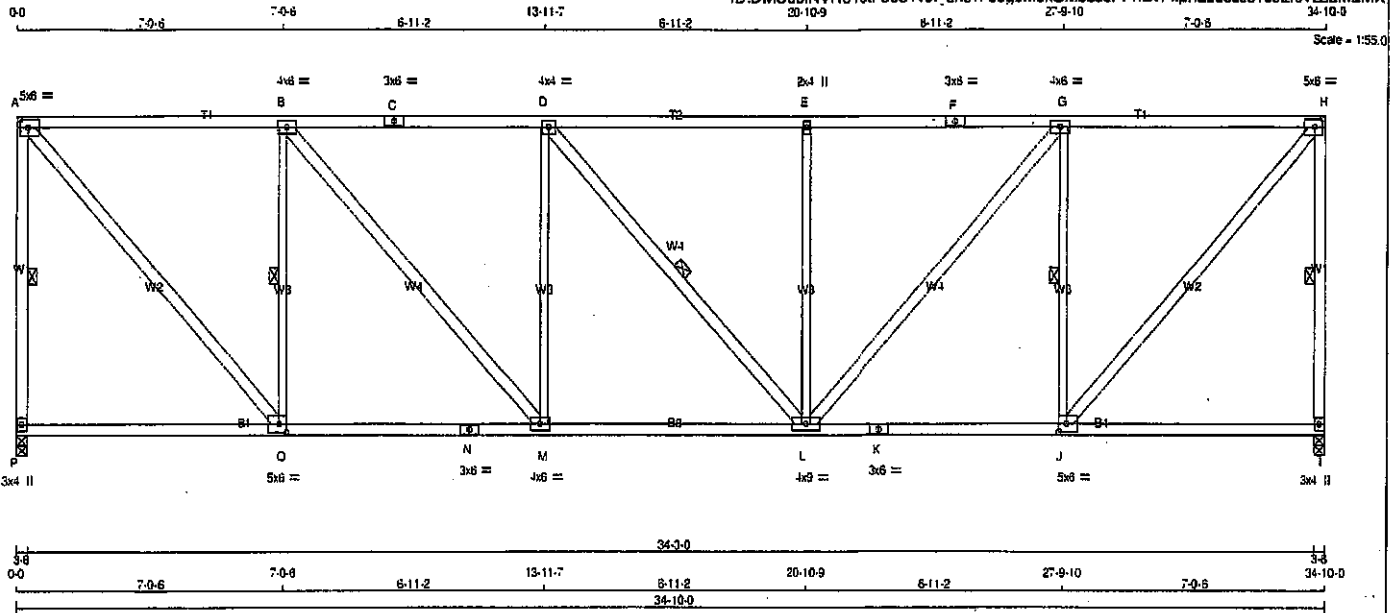

TOTAL WEIGHT = 2 X 179 = 359 lb

LUMBER N.L.G.A. RULES CHORDS SIZE LUMBER P-A 2x4 DRY No.2 A-C 2x4 DRY No.2 C-F 2x4 DRY No.2 F-H 2x4 DRY No.2 I-H 2x4 DRY No.2 P-N 2x4 DRY No.2 N-K 2x4 DRY No.2 K-I 2x4 DRY No.2 ALL WEBS 2x4 DRY No.2 EXCEPT O-S 2x3 DRY No.2 M-D 2x3 DRY No.2 L-E 2x3 DRY No.2 J-G 2x3 DRY No.2 DRY: SEASONED LUMBER.		DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2018, CBC 2012, ABC 2019 - PART 9 OF CBC 2012 (2019 AMENDMENT) - CSA 086-09, CSA 086-14 - TPIC 2011, TPIC 2014 65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL) = L/360 (1.16") CALCULATED VERT. DEFL.(LL) = L/989 (0.12") ALLOWABLE DEFL.(TL) = L/360 (1.16") CALCULATED VERT. DEFL.(TL) = L/989 (0.24") CSI: TC=0.89/1.00 (E-G:1), SC=0.42/1.00 (L-M:1), WB=0.81/1.00 (O-M:1), SS=0.30/1.00 (G-H:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 1.00 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (P.S.I) (P.LI) (P.LI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 788 1987 1658 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP = 0.87 (H) (INPUT = 0.90) JSI METAL = 0.46 (K) (INPUT = 1.00)	
PLATES (table is in inches) JT TYPE PLATES W LEN Y X A TMWV-1 MT20 5.0 6.0 2.50 2.50 B TMWV-1 MT20 4.0 6.0 C TS-1 MT20 3.0 6.0 D TMWV-1 MT20 4.0 4.0 E TMWV-1 MT20 2.0 4.0 F TS-1 MT20 3.0 6.0 G TMWV-1 MT20 4.0 6.0 H TMWV-1 MT20 5.0 6.0 2.50 2.50 I BMV1-p MT20 3.0 4.0 J BMWV-1 MT20 5.0 6.0 2.50 2.50 K BS-1 MT20 3.0 6.0 L BMWV-1 MT20 4.0 9.0 M BMWV-1 MT20 4.0 6.0 N BS-1 MT20 3.0 6.0 O BMWV-1 MT20 5.0 6.0 2.50 2.50 P BMV1-p MT20 3.0 4.0		DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED MAXIMUM FACTORED INPUT REQD GROSS REACTION GROSS REACTION BRG BRG JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX P 1920 0 1920 0 0 3-8 3-8 I 1920 0 1920 0 0 3-8 3-8 UNFACTORED REACTIONS 1ST LCASE MAX. MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL P 1358 891 0 0 0 0 0 467 0 0 I 1358 891 0 0 0 0 0 467 0 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.60 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. 1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-P, H-I, B-O, D-L, G-J. END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW LOADING TOTAL LOAD CASES: (4) CHORDS MEMB. MAX. FACTORED FORCE (LBS) VERT. LOAD LC1 MAX (PLF) CSI (LC) UNBRAC LENGTH FR-TO P-A -1868 0 0.0 0.0 0.57 (1) 4.31 A-O 0 2156 0 0.35 (1) A-B -1432 0 -91.8 -91.8 0.78 (1) 4.31 O-B -1466 0 0.62 (1) B-C -2081 0 -91.8 -91.8 0.89 (1) 3.60 B-M 0 986 0 0.16 (1) C-D -2081 0 -91.8 -91.8 0.89 (1) 3.60 M-D -617 0 0.81 (1) D-E -2080 0 -91.8 -91.8 0.68 (1) 4.00 D-L -2 0 0.00 (1) E-F -2080 0 -91.8 -91.8 0.89 (1) 3.60 L-E -616 0 0.81 (1) F-G -2080 0 -91.8 -91.8 0.89 (1) 3.60 L-G 0 984 0 0.16 (1) G-H -1432 0 -91.8 -91.8 0.78 (1) 4.31 J-G -1466 0 0.82 (1) H-I -1868 0 0.0 0.0 0.57 (1) 4.91 J-H 0 2156 0 0.35 (1) P-O 0 0 -18.5 -18.5 0.22 (4) 10.00 O-N 0 1432 -18.5 -18.5 0.35 (1) 10.00 N-M 0 1432 -18.5 -18.5 0.35 (1) 10.00 M-L 0 2081 -18.5 -18.5 0.42 (1) 10.00 L-K 0 1432 -18.5 -18.5 0.35 (1) 10.00 K-J 0 1432 -18.5 -18.5 0.35 (1) 10.00 J-I 0 0 -18.5 -18.5 0.22 (4) 10.00	




Structural component only
DWG# T-2007641

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T31	5	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTak Industries, Inc. Tue Apr 28 10:04:14 2020 Page 1
ID:DMCubINVR6TsFoe31v6I_zns1aRomBTmfu06nZIZAJKRPu8QxnQKq3skJV95c1SzMEMV

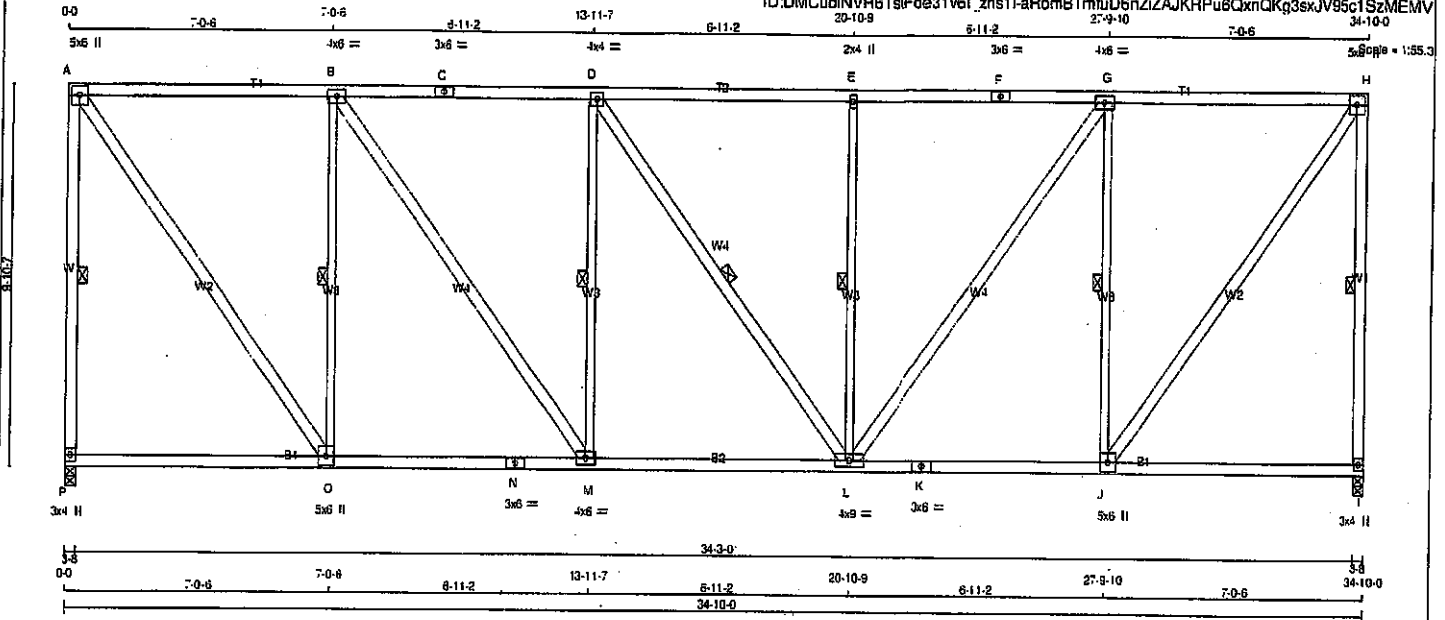

TOTAL WEIGHT = 5 X 196 = 981 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
P - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
I - H	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
ALL WEBS EXCEPT	2x4	DRY	No.2
O - B	2x3	DRY	No.2
M - D	2x3	DRY	No.2
L - E	2x3	DRY	No.2
J - G	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMWW+p	MT20	5.0	6.0
B	TMWW-i	MT20	4.0	6.0
C	TS-i	MT20	3.0	6.0
D	TMWW-i	MT20	4.0	4.0
E	TMWW-w	MT20	2.0	4.0
F	TS-i	MT20	3.0	6.0
G	TMWW-i	MT20	4.0	6.0
H	TMWW+p	MT20	5.0	6.0
I	BMV1+p	MT20	3.0	4.0
J	BMWW-i	MT20	5.0	6.0
K	BS-i	MT20	3.0	6.0
L	BMWW-i	MT20	4.0	6.0
M	BMWW-i	MT20	4.0	6.0
N	BS-i	MT20	3.0	6.0
O	BMWW-i	MT20	5.0	6.0
P	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG	IN-SX
P	1920	0	1920	0	0	0	3-8	3-8	
I	1920	0	1920	0	0	0	3-8	3-8	

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
P	1358	891	0	0	0
I	1358	891	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.98 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-P, H-I, B-O, D-M, D-L, E-L, G-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING		TOTAL LOAD CASES: (4)									
CHORDS					WEBS						
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LOAD LC1 CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)				
FR-TO		FROM	TO		FR-TO						
P-A	-1688 0	0.0	0.0	0.88 (1)	4.91	A-O	0 1999	0.32 (1)			
A-B	-1183 0	-91.8	-91.8	0.75 (1)	4.69	C-B	-1466 0	0.96 (1)			
B-C	-1719 0	-91.8	-91.8	0.82 (1)	3.98	Q-M	0 916	0.15 (1)			
C-D	-1719 0	-91.8	-91.8	0.82 (1)	3.88	M-D	-617 0	0.41 (1)			
D-E	-1718 0	-91.8	-91.8	0.63 (1)	4.37	D-L	-2 0	0.00 (1)			
E-F	-1718 0	-91.8	-91.8	0.83 (1)	3.36	L-E	-616 0	0.41 (1)			
F-G	-1718 0	-91.8	-91.8	0.83 (1)	3.96	G-E	0 913	0.15 (1)			
G-H	-1183 0	-91.8	-91.8	0.75 (1)	4.69	J-G	-1465 0	0.96 (1)			
H-I	-1688 0	0.0	0.0	0.88 (1)	4.91	J-H	0 2000	0.32 (1)			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSI: TC=0.88/1.00 (H-H:1), BC=0.36/1.00 (L-M:1), WB=0.96/1.00 (B-O:1), SSI=0.30/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (H) (INPUT = 0.90)
JSI METAL = 0.43 (H) (INPUT = 1.00)



Structural component only
DWG# T-2007642

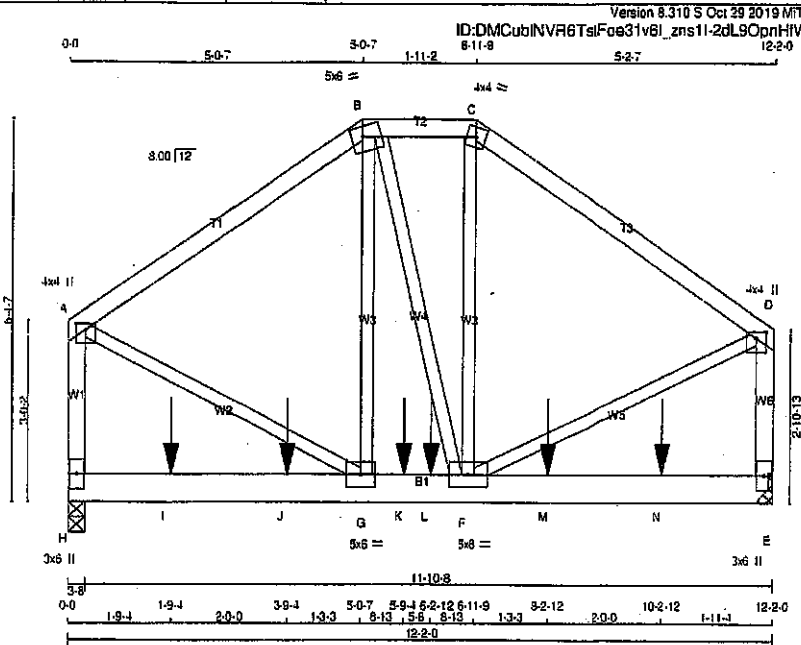

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:04:15 2020 Page 1
 ID:DMCubINVR6TslFoe31v6L_zns11-2dLSOpnHWEsAs8Mt1yeRKzCFqAqVATkprAeuzMEMU
 6-11-8 12-2-0 Scale = 1:35.6

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
H - A	2x4	DRY	No.2
E - D	2x4	DRY	No.2
H - E	2x6	DRY	No.2

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25 2.00
B	TTWW-m	MT20	5.0	6.0	2.00 2.25
C	TTWW-m	MT20	4.0	4.0	
D	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMV1+p	MT20	3.0	6.0	
F	BMVWV+1	MT20	5.0	8.0	
G	BMVWV+1	MT20	5.0	6.0	
H	BMV1+p	MT20	3.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT VERT	DOWN	UP	IN-SX
H 1233 0	1233 0	3-8	3-8
E 1218 0	1218 0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 3'-8".

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
H 867 598 0 0 0 0 0 0 271 0 0 0	
E 856 588 0 0 0 0 0 0 268 0 0 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.77 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX CS1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)
FR-TO		FROM TO			FR-TO		
A-B	-853 0	-91.8 -91.8	0.48 (1)	5.88	G-B	0 122	0.03 (1)
B-C	-721 0	-91.8 -91.8	0.07 (1)	6.25	B-F	0 34	0.01 (1)
C-D	-854 0	-91.8 -91.8	0.51 (1)	5.77	F-C	0 154	0.04 (1)
H-A	-1085 0	0.0 0.0	0.17 (1)	7.60	A-G	0 785	0.20 (1)
E-D	-1057 0	0.0 0.0	0.16 (1)	7.63	F-D	0 794	0.20 (1)
H-I	0 0	-18.5 -18.5	0.20 (1)	10.00			
I-J	0 0	-18.5 -18.5	0.20 (1)	10.00			
J-G	0 0	-18.5 -18.5	0.20 (1)	10.00			
G-K	0 711	-18.5 -18.5	0.28 (1)	10.00			
K-L	0 711	-18.5 -18.5	0.28 (1)	10.00			
L-F	0 711	-18.5 -18.5	0.28 (1)	10.00			
F-M	0 0	-18.5 -18.5	0.20 (1)	10.00			
M-N	0 0	-18.5 -18.5	0.20 (1)	10.00			
N-E	0 0	-18.5 -18.5	0.20 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
I	1-9-4	-172	-172	---	BACK	VERT	TOTAL	C1
J	3-9-4	-195	-195	---	BACK	VERT	TOTAL	C1
K	5-9-4	-187	-187	---	BACK	VERT	TOTAL	C1
L	6-2-12	-187	-187	---	BACK	VERT	TOTAL	C1
M	8-2-12	-195	-195	---	BACK	VERT	TOTAL	C1
N	10-2-12	-172	-172	---	BACK	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 086-14
 - TPC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.41")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
 ALLOWABLE DEFL.(TL) = L/360 (0.41")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CS1: TC=0.51 1.00 (C-D-1), BC=0.28 1.00 (F-G-1), WB=0.20 1.00 (A-G-1), SS=0.20 1.00 (E-F-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20 618 354	1667 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.78 (D) INPUT = 0.90
 JSI METAL= 0.23 (D) INPUT = 1.00




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T34S	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 23 2019 Mitek Industries, Inc. Tue Apr 28 10:04:16 2020 Page 1

ID:DMCubINVR6TstFos31v6l_zns1l-WqvXc9ovQgMVo0ZQkUtzXVSIE5FX?ycztaj6KzMEMT

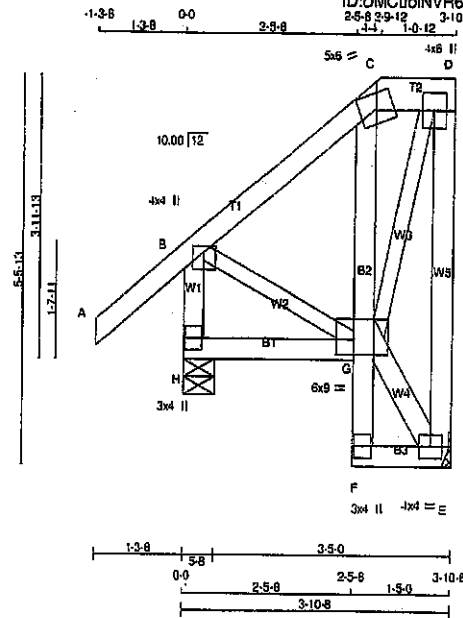

Scale = 1/20.1

TOTAL WEIGHT = 2 X 32 = 64 lb (M)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY No.2	SPF			
C - D	2x4 DRY No.2	SPF			
E - D	2x4 DRY No.2	SPF			
H - B	2x4 DRY No.2	SPF			
H - G	2x4 DRY No.2	SPF			
F - C	2x4 DRY No.2	SPF			
F - E	2x4 DRY No.2	SPF			
ALL WEBS EXCEPT	2x4 DRY No.2	SPF			
B - G	2x3 DRY No.2	SPF			
G - D	2x3 DRY No.2	SPF			

DRY: SEASONED LUMBER.

<u>PLATES (table is in inches)</u>						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTV-m	MT20	5.0	6.0		
D	TMVW+p	MT20	4.0	6.0		
E	BMVW1-i	MT20	4.0	4.0		
F	BMV+p	MT20	3.0	4.0		
G	BVMWW-i	MT20	6.0	9.0	2.50	3.00
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REORD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
E	VERT	DOWN	0	0
H	HORIZ	UP	0	0
			MECHANICAL	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS	1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
E	151	99 0 0 0 0 0 52 0 0 0
H	239	170 0 0 0 0 0 69 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC7 MAX (PLF) CSI (LC) UNBRAC LENGTH FR-TO	MEMB.	FORCE (LBS) MAX (CSI) (LC)
A-B	0 41	-91.8 -91.8 0.14 (5) 10.00	G-E	0 0 0.00 (1)
B-C	-62 0	-91.8 -91.8 0.12 (1) 6.25	B-G	0 53 0.01 (1)
C-D	-51 0	-91.8 -91.8 0.01 (1) 6.25	G-D	0 154 0.03 (1)
E-D	-197 0	0.0 0.0 0.10 (1) 7.81		
H-B	-317 0	0.0 0.0 0.03 (1) 7.81		
H-G	0 0	-18.5 -18.5 0.04 (4) 10.00		
F-G	0 13	0.0 0.0 0.01 (1) 10.00		
G-C	-138 0	0.0 0.0 0.01 (1) 7.81		
F-E	0 4	-18.5 -18.5 0.01 (4) 10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14:1.00 (A-B-5), BC=0.04:1.00 (G-H-4), WB=0.03:1.00 (D-G-1), SS=0.09:1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.24 (B) INPUT = 0.90
JSI METAL = 0.06 (B) INPUT = 1.00




Structural component only
DWG# T-2007644

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	T35S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

ID:DMCub\NVR6TstFos31v6l_zns1f-0TvpVoXB8UMQAHl_S76Wl2dVdRQGSEmC7KGenzMEMS

Version 8.310 S Oct 29 2019 M/Tek Industries, Inc. Tue Apr 26 10:04:17 2020 Page 1

Scale = 1/23.4

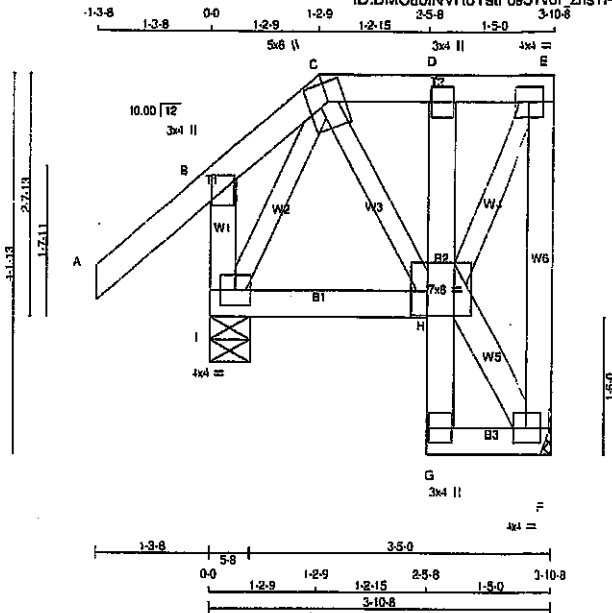

TOTAL WEIGHT = 2 X 29 = 57 lb

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
I - B	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
G - D	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (Table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TTWV+um	MT20	5.0	6.0	2.50 2.25
D	TMV+p	MT20	3.0	4.0	
E	TMVW-1	MT20	4.0	4.0	
F	BMVW-1	MT20	4.0	4.0	
G	BMV+p	MT20	3.0	4.0	
H	BMVWVW-1	MT20	7.0	8.0	3.25 2.25
I	BMVW-1	MT20	4.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
F	191	0	191	0	0
I	383	0	383	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS		1ST CASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
F	135	88	13	0	0	0	0	48	0
I	254	183	0	0	0	0	0	72	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING		TOTAL LOAD CASES: (5)		CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 41	-91.8 -91.8 0.14 (5)	10.00	H-F	-6 0	0.00 (1)	
B-C	-45 0	-91.8 -91.8 0.14 (5)	6.25	H-E	0 141	0.03 (1)	
C-D	-69 0	-91.8 -91.8 0.02 (1)	6.25	C-H	0 48	0.01 (1)	
D-E	-67 0	-91.8 -91.8 0.02 (1)	6.25	I-C	-96 28	0.02 (1)	
F-E	-175 0	0.0 0.0 0.05 (1)	7.81				
I-B	-255 0	0.0 0.0 0.03 (1)	7.81				
I-H	-13 45	-18.5 -18.5 0.04 (4)	6.25				
G-H	0 13	0.0 0.0 0.01 (1)	10.00				
H-D	-135 0	0.0 0.0 0.01 (1)	7.81				
G-F	0 4	-18.5 -18.5 0.01 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/989 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/989 (0.00")

CSI: TC=0.14/1.00 (A-B-S), BC=0.04/1.00 (H-I), WB=0.03/1.00 (E-H-I), SS=0.09/1.00 (A-B-S)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (E) (INPUT = 0.50)
JSI METAL= 0.09 (B) (INPUT = 1.00)

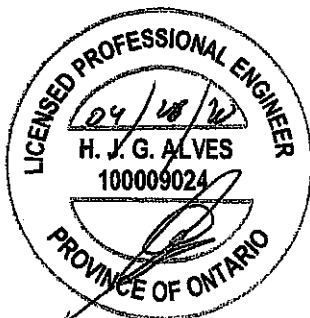


Structural component only
DWG# T-2007645

JOB NAME 408223	TRUSS NAME T36	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:04:18 2020 Page 1
ID:DMCubiNVR6TsFoe31v8f zns11-TC1H0rp9yRcD1KaxY9WL2ybo51j27vNvQn3qBDzMEMR

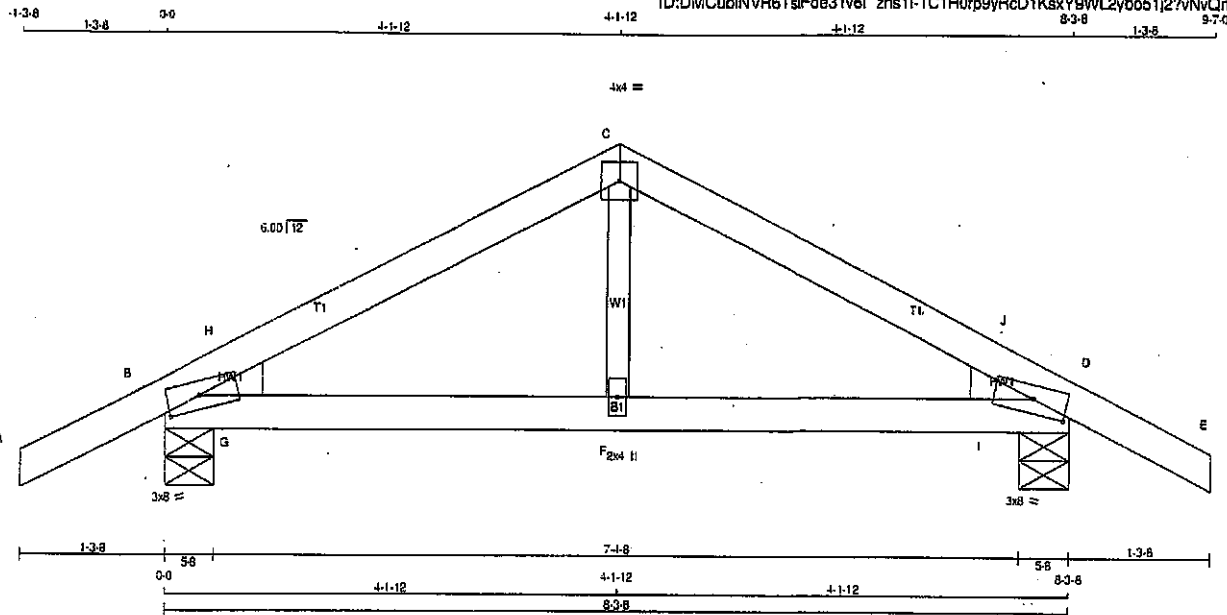

Scale = 1:18.9

LUMBER				DESIGN CRITERIA			
N. L. G. A. RULES				SPECIFIED LOADS:			
CHORDS	SIZE	DRY	LUMBER	TOP CH.	LL	25.6	PSF
A - C	2x4	DRY	No.2	DL	6.0	PSF	
C - E	2x4	DRY	No.2	BOT CH.	LL	0.0	PSF
B - D	2x4	DRY	No.2	DL	7.4	PSF	
ALL WEBS 2x3 DRY				TOTAL LOAD = 39.0 PSF			
DRY: SEASONED LUMBER.				TOTAL WEIGHT = 3 X 27 = 80 lb			

PLATES (tablets in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMBH1-m	MT20	3.0	8.0	1.50	3.75
C TTW-p	MT20	4.0	4.0		
D TMBH1-m	MT20	3.0	8.0	1.50	3.75
F BMW-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	HEEL	WEDGE
B	582	0	582	0	0	5-8	5-8	2x4 L	
D	582	0	582	0	0	5-8	5-8	2x4 R	

UNFACTORED REACTIONS		1ST LCASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
B	409	282	0	0	0
D	409	282	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)	
CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	0 23	F-C	0 170
B-H	-539 0	G-H	-158 3
H-C	-525 0	I-J	-158 3
C-J	-525 0		
J-D	-539 0		
D-E	0 23		
B-G	0 465		
G-F	0 465		
F-I	0 465		
I-D	0 465		

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.28")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.15(1.00 (C-J:1), BC=0.21(1.00 (F-I:1), WB=0.04(1.00 (C-F:1), SS=0.12(1.00 (C-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP(DRY) SHEAR	SECTION	(PSI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1867 788	1987 1858


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.25 (B) (INPUT = 0.90)
JSI METAL= 0.11 (B) (INPUT = 1.00)

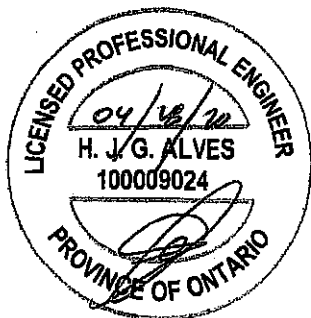

Structural component only
DWG# T-2007646

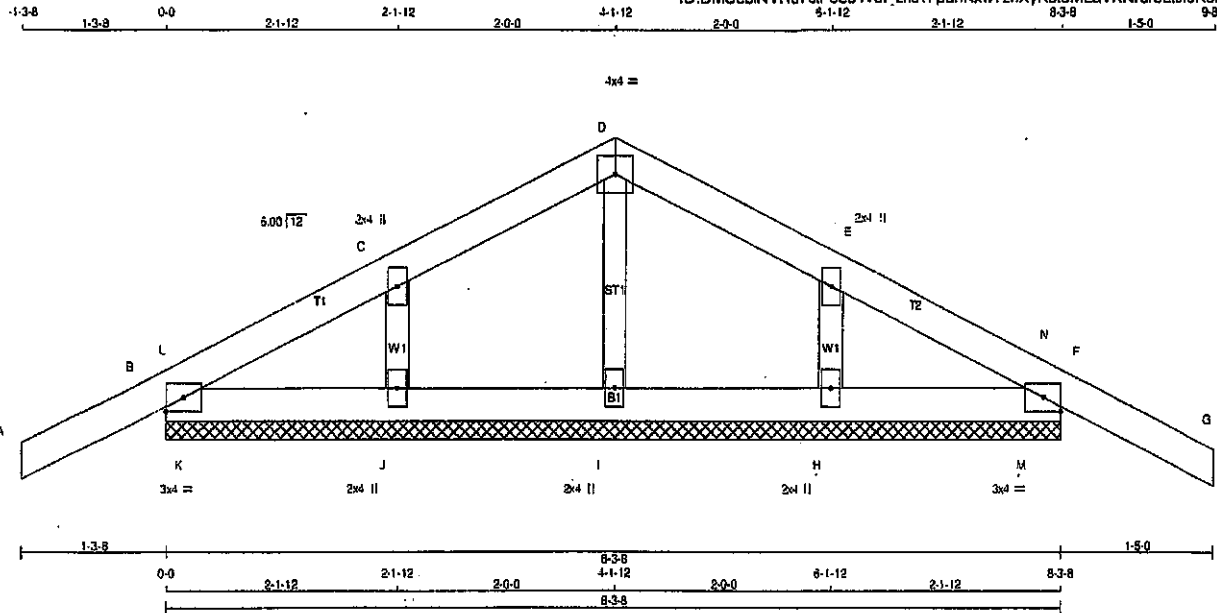

Scale = 1/19.1

TOTAL WEIGHT = 27 lb

LUMBER N. L. G. A. RULES <table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th>CHORDS</th> <th>SIZE</th> <th>LUMBER</th> <th>DESCR.</th> </tr> <tr> <td>A - D</td> <td>2x4</td> <td>DRY</td> <td>No.2</td> </tr> <tr> <td>D - G</td> <td>2x4</td> <td>DRY</td> <td>No.2</td> </tr> <tr> <td>B - F</td> <td>2x4</td> <td>DRY</td> <td>No.2</td> </tr> </table> ALL WEBS 2x3 DRY No.2 SPF ALL GABLE WEBS 2x3 DRY No.2 SPF DRY: SEASONED LUMBER. GABLE STUDS SPACED AT 2-0-0 OC. PLATES (table in inches) <table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th>JT</th> <th>TYPE</th> <th>PLATES</th> <th>W</th> <th>LEN</th> <th>Y</th> <th>X</th> </tr> <tr> <td>B</td> <td>TMB1-I</td> <td>MT20</td> <td>3.0</td> <td>4.0</td> <td></td> <td>Edge</td> </tr> <tr> <td>C</td> <td>TMW+V</td> <td>MT20</td> <td>2.0</td> <td>4.0</td> <td></td> <td></td> </tr> <tr> <td>D</td> <td>TTW+P</td> <td>MT20</td> <td>4.0</td> <td>4.0</td> <td></td> <td></td> </tr> <tr> <td>E</td> <td>TMW+V</td> <td>MT20</td> <td>2.0</td> <td>4.0</td> <td></td> <td></td> </tr> <tr> <td>F</td> <td>TMB1-I</td> <td>MT20</td> <td>3.0</td> <td>4.0</td> <td></td> <td>Edge</td> </tr> <tr> <td>H, I, J</td> <td>BMW1+V</td> <td>MT20</td> <td>2.0</td> <td>4.0</td> <td></td> <td></td> </tr> </table> Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.	CHORDS	SIZE	LUMBER	DESCR.	A - D	2x4	DRY	No.2	D - G	2x4	DRY	No.2	B - F	2x4	DRY	No.2	JT	TYPE	PLATES	W	LEN	Y	X	B	TMB1-I	MT20	3.0	4.0		Edge	C	TMW+V	MT20	2.0	4.0			D	TTW+P	MT20	4.0	4.0			E	TMW+V	MT20	2.0	4.0			F	TMB1-I	MT20	3.0	4.0		Edge	H, I, J	BMW1+V	MT20	2.0	4.0			DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS. THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE. BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNSPACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED. LOADING TOTAL LOAD CASES: (4) <table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="4">CHORDS</th> <th colspan="4">WEBS</th> </tr> <tr> <th>MEMB.</th> <th>MAX. FACTORED FORCE (LBS)</th> <th>FACTORED VERT. LOAD (PL)</th> <th>MAX. FACTORED CS (LC)</th> <th>MEMB.</th> <th>MAX. FACTORED FORCE (LBS)</th> <th>MAX. FACTORED CS (LC)</th> </tr> <tr> <td>FR-TO</td> <td></td> <td>FROM TO</td> <td></td> <td>FR-TO</td> <td></td> <td></td> </tr> <tr> <td>A-B</td> <td>0 23</td> <td>-91.8 -91.8 0.12 (1)</td> <td>10.00</td> <td>I-D</td> <td>-115 0</td> <td>0.02 (1)</td> </tr> <tr> <td>B-L</td> <td>-61 0</td> <td>-91.8 -91.8 0.01 (4)</td> <td>6.25</td> <td>J-C</td> <td>-218 0</td> <td>0.03 (1)</td> </tr> <tr> <td>L-C</td> <td>-39 0</td> <td>-91.8 -91.8 0.06 (1)</td> <td>6.25</td> <td>H-E</td> <td>-218 0</td> <td>0.03 (1)</td> </tr> <tr> <td>C-D</td> <td>-45 0</td> <td>-91.8 -91.8 0.06 (1)</td> <td>6.25</td> <td>K-L</td> <td>-52 7</td> <td>0.00 (1)</td> </tr> <tr> <td>D-E</td> <td>-45 0</td> <td>-91.8 -91.8 0.06 (1)</td> <td>6.25</td> <td>M-N</td> <td>-52 7</td> <td>0.00 (1)</td> </tr> <tr> <td>E-N</td> <td>-39 0</td> <td>-91.8 -91.8 0.06 (1)</td> <td>6.25</td> <td></td> <td></td> <td></td> </tr> <tr> <td>N-F</td> <td>-61 0</td> <td>-91.8 -91.8 0.01 (4)</td> <td>6.25</td> <td></td> <td></td> <td></td> </tr> <tr> <td>F-G</td> <td>0 25</td> <td>-91.8 -91.8 0.14 (1)</td> <td>10.00</td> <td></td> <td></td> <td></td> </tr> <tr> <td>B-K</td> <td>0 44</td> <td>-18.5 -18.5 0.03 (1)</td> <td>10.00</td> <td></td> <td></td> <td></td> </tr> <tr> <td>K-J</td> <td>0 44</td> <td>-18.5 -18.5 0.03 (1)</td> <td>10.00</td> <td></td> <td></td> <td></td> </tr> <tr> <td>J-I</td> <td>0 32</td> <td>-18.5 -18.5 0.02 (1)</td> <td>10.00</td> <td></td> <td></td> <td></td> </tr> <tr> <td>I-H</td> <td>0 32</td> <td>-18.5 -18.5 0.02 (1)</td> <td>10.00</td> <td></td> <td></td> <td></td> </tr> <tr> <td>H-M</td> <td>0 44</td> <td>-18.5 -18.5 0.03 (1)</td> <td>10.00</td> <td></td> <td></td> <td></td> </tr> <tr> <td>M-F</td> <td>0 44</td> <td>-18.5 -18.5 0.03 (1)</td> <td>10.00</td> <td></td> <td></td> <td></td> </tr> </table>	CHORDS				WEBS				MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. FACTORED CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)	FR-TO		FROM TO		FR-TO			A-B	0 23	-91.8 -91.8 0.12 (1)	10.00	I-D	-115 0	0.02 (1)	B-L	-61 0	-91.8 -91.8 0.01 (4)	6.25	J-C	-218 0	0.03 (1)	L-C	-39 0	-91.8 -91.8 0.06 (1)	6.25	H-E	-218 0	0.03 (1)	C-D	-45 0	-91.8 -91.8 0.06 (1)	6.25	K-L	-52 7	0.00 (1)	D-E	-45 0	-91.8 -91.8 0.06 (1)	6.25	M-N	-52 7	0.00 (1)	E-N	-39 0	-91.8 -91.8 0.06 (1)	6.25				N-F	-61 0	-91.8 -91.8 0.01 (4)	6.25				F-G	0 25	-91.8 -91.8 0.14 (1)	10.00				B-K	0 44	-18.5 -18.5 0.03 (1)	10.00				K-J	0 44	-18.5 -18.5 0.03 (1)	10.00				J-I	0 32	-18.5 -18.5 0.02 (1)	10.00				I-H	0 32	-18.5 -18.5 0.02 (1)	10.00				H-M	0 44	-18.5 -18.5 0.03 (1)	10.00				M-F	0 44	-18.5 -18.5 0.03 (1)	10.00				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. O.C. THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF BCBC 2018, CBC 2012, ABC 2019 - PART 9 OF CBC 2012 (2019 AMENDMENT) - CSA 086-09, CSA 086-14 - TPIC 2011, TPIC 2014 (55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD CS1: TC=0.14/1.00 (F-G:1), BC=0.03/1.00 (H-M:1), WB=0.03/1.00 (E-H:1), SS1=0.10/1.00 (F-G:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 1.00 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES <table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th>PLATE GRIP (DRY)</th> <th>SHEAR</th> <th>SECTION</th> </tr> <tr> <th>(PSI)</th> <th>(PL)</th> <th>(PL)</th> </tr> <tr> <td>MAX MIN</td> <td>MAX MIN</td> <td>MAX MIN</td> </tr> <tr> <td>MT20</td> <td>618 354</td> <td>1667 788</td> </tr> </table> 1987 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP = 0.21 (B) (INPUT = 0.90) JSI METAL = 0.09 (C) (INPUT = 1.00)	PLATE GRIP (DRY)	SHEAR	SECTION	(PSI)	(PL)	(PL)	MAX MIN	MAX MIN	MAX MIN	MT20	618 354	1667 788
CHORDS	SIZE	LUMBER	DESCR.																																																																																																																																																																																																				
A - D	2x4	DRY	No.2																																																																																																																																																																																																				
D - G	2x4	DRY	No.2																																																																																																																																																																																																				
B - F	2x4	DRY	No.2																																																																																																																																																																																																				
JT	TYPE	PLATES	W	LEN	Y	X																																																																																																																																																																																																	
B	TMB1-I	MT20	3.0	4.0		Edge																																																																																																																																																																																																	
C	TMW+V	MT20	2.0	4.0																																																																																																																																																																																																			
D	TTW+P	MT20	4.0	4.0																																																																																																																																																																																																			
E	TMW+V	MT20	2.0	4.0																																																																																																																																																																																																			
F	TMB1-I	MT20	3.0	4.0		Edge																																																																																																																																																																																																	
H, I, J	BMW1+V	MT20	2.0	4.0																																																																																																																																																																																																			
CHORDS				WEBS																																																																																																																																																																																																			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. FACTORED CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)																																																																																																																																																																																																	
FR-TO		FROM TO		FR-TO																																																																																																																																																																																																			
A-B	0 23	-91.8 -91.8 0.12 (1)	10.00	I-D	-115 0	0.02 (1)																																																																																																																																																																																																	
B-L	-61 0	-91.8 -91.8 0.01 (4)	6.25	J-C	-218 0	0.03 (1)																																																																																																																																																																																																	
L-C	-39 0	-91.8 -91.8 0.06 (1)	6.25	H-E	-218 0	0.03 (1)																																																																																																																																																																																																	
C-D	-45 0	-91.8 -91.8 0.06 (1)	6.25	K-L	-52 7	0.00 (1)																																																																																																																																																																																																	
D-E	-45 0	-91.8 -91.8 0.06 (1)	6.25	M-N	-52 7	0.00 (1)																																																																																																																																																																																																	
E-N	-39 0	-91.8 -91.8 0.06 (1)	6.25																																																																																																																																																																																																				
N-F	-61 0	-91.8 -91.8 0.01 (4)	6.25																																																																																																																																																																																																				
F-G	0 25	-91.8 -91.8 0.14 (1)	10.00																																																																																																																																																																																																				
B-K	0 44	-18.5 -18.5 0.03 (1)	10.00																																																																																																																																																																																																				
K-J	0 44	-18.5 -18.5 0.03 (1)	10.00																																																																																																																																																																																																				
J-I	0 32	-18.5 -18.5 0.02 (1)	10.00																																																																																																																																																																																																				
I-H	0 32	-18.5 -18.5 0.02 (1)	10.00																																																																																																																																																																																																				
H-M	0 44	-18.5 -18.5 0.03 (1)	10.00																																																																																																																																																																																																				
M-F	0 44	-18.5 -18.5 0.03 (1)	10.00																																																																																																																																																																																																				
PLATE GRIP (DRY)	SHEAR	SECTION																																																																																																																																																																																																					
(PSI)	(PL)	(PL)																																																																																																																																																																																																					
MAX MIN	MAX MIN	MAX MIN																																																																																																																																																																																																					
MT20	618 354	1667 788																																																																																																																																																																																																					




Structural component only
DWG# T-2007621

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	T37	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 2.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:04:19 2020 Page 1
ID:DMCubINVR6TstFoe31v6L_zris1-xPofEBqnIK4tUR76t1abA7yUR47K1zMEMQ

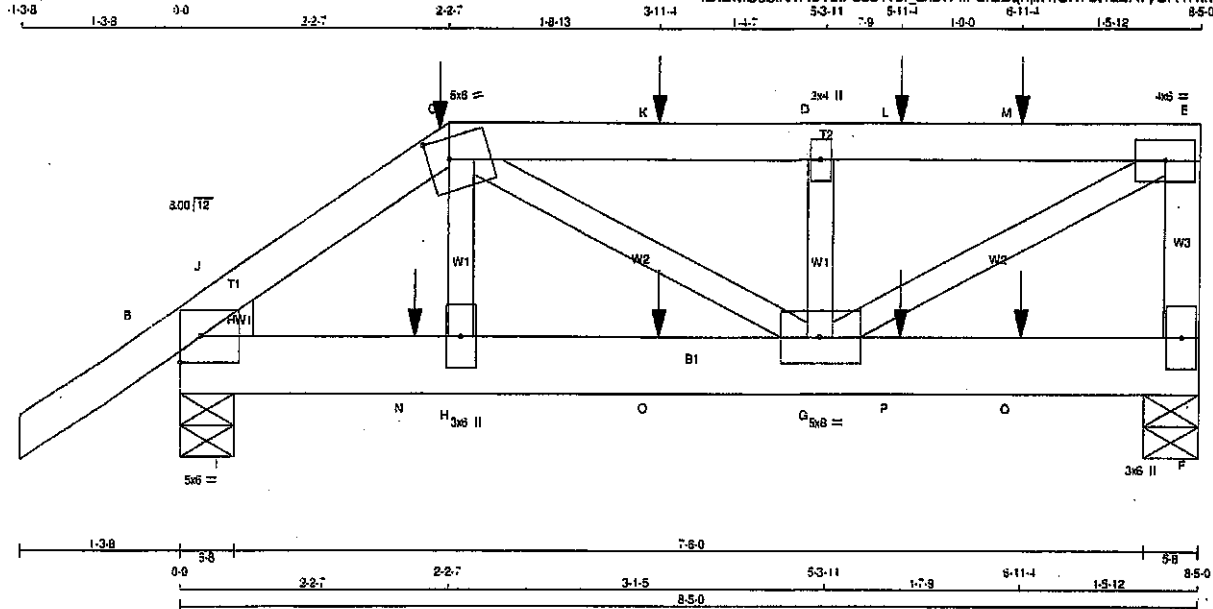

Scale = 1:17.0

TOTAL WEIGHT = 37 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
B - F	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMBH1-L	MT20	5.0	8.0	Edge
C	TTWW-m	MT20	5.0	6.0	2.00 2.00
D	TWW-w	MT20	2.0	4.0	
E	TWW-w	MT20	4.0	6.0	
F	BMV1-p	MT20	3.0	6.0	
G	BMVWW-L	MT20	5.0	8.0	
H	BMV-w	MT20	3.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	REQD	HEEL
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
F	780	0	780	0	5-8	5-8
B	823	0	823	0	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	537	352	0	0	0	185	0
B	590	392	0	0	0	188	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	FORCE	FACTORED	VERT. LOAD	LC1 MAX	MAX.	MEMB.	FORCE	FACTORED	MAX
	(LBS)		(PLF)	CSI (LC)	UNBRAC		(LBS)		CSI (LC)
FR-TO			FROM TO		LENGTH	FR-TO			
A-B	0 26		-91.8 -91.8	0.13 (1)	10.00	H-C	0 73		0.02 (4)
B-J	-1068 0		-91.8 -91.8	0.08 (1)	5.99	C-G	0 252		0.06 (1)
J-C	-890 0		-91.8 -91.8	0.08 (1)	6.25	G-D	-528 0		0.09 (1)
C-K	-923 0		-91.8 -91.8	0.24 (1)	6.09	G-E	0 1062		0.26 (1)
K-D	-923 0		-91.8 -91.8	0.24 (1)	6.09	I-J	0 207		0.00 (1)
D-L	-924 0		-91.8 -91.8	0.24 (1)	6.09				
L-M	-924 0		-91.8 -91.8	0.24 (1)	6.09				
M-E	-924 0		-91.8 -91.8	0.24 (1)	6.09				
F-E	-582 0		0.0 0.0	0.08 (1)	7.81				
B-I	0 701		-18.5 -18.5	0.14 (1)	10.00				
I-N	0 701		-18.5 -18.5	0.14 (1)	10.00				
N-H	0 701		-18.5 -18.5	0.14 (1)	10.00				
H-O	0 705		-18.5 -18.5	0.15 (1)	10.00				
O-G	0 705		-18.5 -18.5	0.15 (1)	10.00				
G-P	0 0		-18.5 -18.5	0.07 (1)	10.00				
P-Q	0 0		-18.5 -18.5	0.07 (1)	10.00				
Q-F	0 0		-18.5 -18.5	0.07 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-2-7	-88	-88	---	FRONT	VERT	TOTAL	---	C1
K	3-11-4	-83	-83	---	FRONT	VERT	TOTAL	---	C1
L	5-11-4	-83	-83	---	FRONT	VERT	TOTAL	---	C1
M	6-11-4	-83	-83	---	FRONT	VERT	TOTAL	---	C1
N	1-11-4	-48	-48	---	FRONT	VERT	TOTAL	---	C1
O	3-11-4	-48	-48	---	FRONT	VERT	TOTAL	---	C1
P	5-11-4	-48	-48	---	FRONT	VERT	TOTAL	---	C1
Q	6-11-4	-48	-48	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.28")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.28")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.24, 1.00 (D-E:1), BC=0.15, 1.00 (G-H:1), WB=0.26, 1.00 (E-G:1), SS=0.25, 1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.61 (E) (INPUT = 0.90)
JSI METAL= 0.24 (E) (INPUT = 1.00)


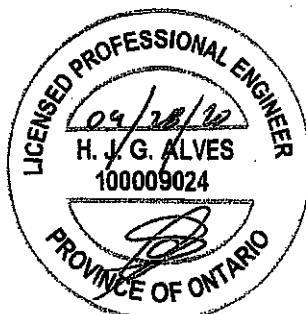


Structural component only
DWG# T-2007647

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408224	T40	1	2	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:57 2020 Page 1

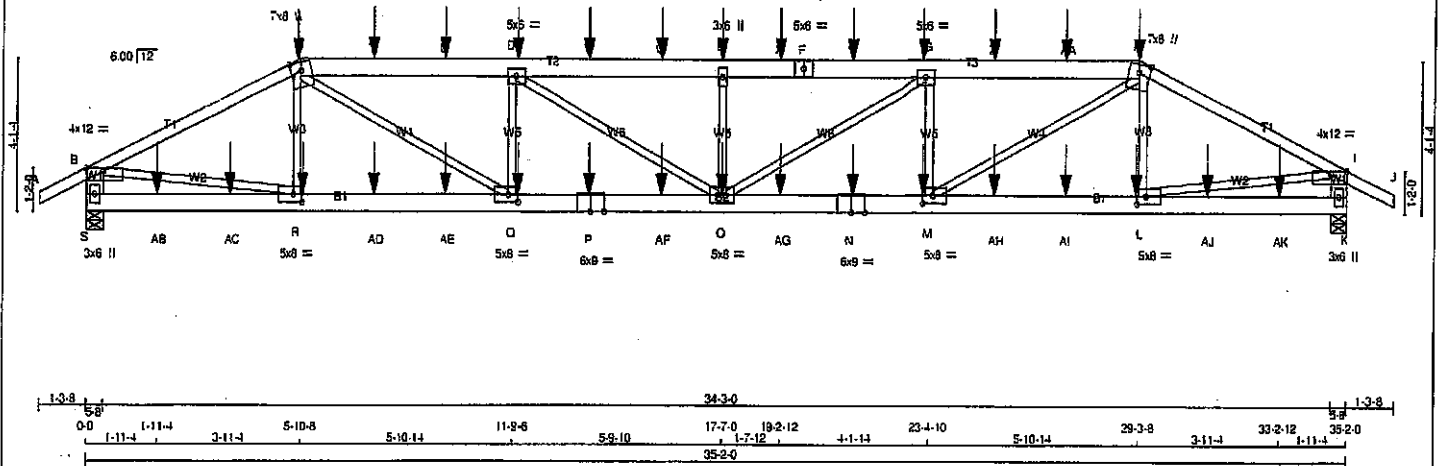

TOTAL WEIGHT = 2 X 169 = 338 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY				DESIGN CRITERIA			
N L G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD	SPECIFIED LOADS:	
A - C	2x4	DRY	No.2	SPF	JT	CROSS REACTION	CROSS REACTION	BRG	BRG	TOP CH. LL = 25.8 PSF	
C - F	2x6	DRY	No.2	SPF	S	VERT	DOWN	0	5-8	DL = 8.0 PSF	
F - H	2x4	DRY	No.2	SPF	K	HORZ	HORZ	0	5-8	BOT CH. LL = 0.0 PSF	
H - J	2x4	DRY	No.2	SPF						DL = 7.4 PSF	
J - L	2x6	DRY	No.2	SPF						TOTAL LOAD = 39.0 PSF	
L - P	2x6	DRY	No.2	SPF							
P - N	2x6	DRY	1650F 1.5E	SPF							
N - K	2x6	DRY	1650F 1.5E	SPF							
ALL WEBS	2x3	DRY	No.2	SPF							
EXCEPT											

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C 1	12	SIDE(81.0)
H-J 1	12	SIDE(81.0)
C-F 2	12	SIDE(183.1)
F-H 2	12	SIDE(183.1)
S-B 2	12	TOP
K-I 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S-P 2	12	SIDE(183.1)
P-N 2	12	SIDE(183.1)
N-K 2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.



Structural component only
DWG# T-2007660 1/2

LOADING				TOTAL LOAD CASES: (4)			
CHORDS	MEMB.	FORCE (LBS)	FACTORED	CHORDS	MEMB.	FORCE (LBS)	FACTORED
FR-TO				FR-TO			
A-B	0	28	-91.8 -91.8 0.07 (1)	R-C	-413	20	0.05 (1)
B-C	-5068	0	-91.8 -91.8 0.52 (1)	C-D	0	3193	0.40 (1)
C-T	-7264	0	-91.8 -91.8 0.27 (1)	D-E	-1500	0	0.18 (1)
T-U	-7264	0	-91.8 -91.8 0.27 (1)	E-F	0	946	0.12 (1)
U-D	-7264	0	-91.8 -91.8 0.27 (1)	F-G	-830	0	0.10 (1)
D-V	-8064	0	-91.8 -91.8 0.27 (1)	G-H	0	946	0.12 (1)
V-W	-8064	0	-91.8 -91.8 0.27 (1)	H-I	-1500	0	0.18 (1)
W-E	-8064	0	-91.8 -91.8 0.27 (1)	I-J	0	3193	0.40 (1)
E-X	-8064	0	-91.8 -91.8 0.27 (1)	J-K	-413	20	0.05 (1)
X-F	-8064	0	-91.8 -91.8 0.27 (1)	K-L	0	4582	0.57 (1)
F-Y	-8064	0	-91.8 -91.8 0.27 (1)	L-I	0	4582	0.57 (1)
Y-G	-8064	0	-91.8 -91.8 0.27 (1)				
G-Z	-7264	0	-91.8 -91.8 0.27 (1)				
Z-AA	-7264	0	-91.8 -91.8 0.27 (1)				
AA-H	-7264	0	-91.8 -91.8 0.27 (1)				
H-I	-5068	0	-91.8 -91.8 0.52 (1)				
I-J	0	28	-91.8 -91.8 0.07 (1)				
J-K	-3248	0	0.0 0.0 0.11 (1)				
K-L	-3248	0	0.0 0.0 0.11 (1)				

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX	FACE	DIR.	TYPE	HEEL
C	5-10-8	-429	-429	---	FRONT	VERT	---
D	11-11-4	-110	-110	---	FRONT	VERT	---

55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L 360 (1.17")
CALCULATED VERT. DEFL.(LL) = L 999 (0.21")
ALLOWABLE DEFL.(TL) = L 360 (1.17")
CALCULATED VERT. DEFL.(TL) = L 999 (0.39")

CSI: TC=0.52-1.00 (B-C:1), BC=0.34-1.00 (C-Q:1),
WB=0.57-1.00 (B-R:1), SS=0.15-1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1687
			788
			1987
			1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.56 (R) (INPUT = 0.90)
JSI METAL= 0.56 (P) (INPUT = 1.00)

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T40	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:19:57 2020 Page 2
ID:DMCubINVR6TsFoe31v8I zns11-TsGG5wA9pyv BdB2IsXcz APYAVTa7LN10dizME7m

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	12.0	1.00	5.50
C	TTWW-m	MT20	7.0	8.0	Edge	
D	TMVW-t	MT20	5.0	6.0		
E	TMVW-w	MT20	3.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMVW-t	MT20	5.0	6.0		
H	TTWW-m	MT20	7.0	8.0	Edge	
I	TMVW-p	MT20	4.0	12.0	1.00	5.50
K	BMV1-p	MT20	3.0	9.0		
L	BMVW-t	MT20	5.0	8.0	2.50	3.00
M	BMVW-t	MT20	5.0	8.0	2.50	3.25
N	BS-t	MT20	6.0	9.0		
O	BMVW-t	MT20	5.0	8.0		
P	BS-t	MT20	6.0	9.0		
Q	BMVW-t	MT20	5.0	8.0	2.50	3.25
R	BMVW-t	MT20	5.0	8.0	2.50	3.00
S	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	17-7-0	-110	-110	---	FRONT	VERT	TOTAL	---	C1
G	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	29-3-8	-429	-429	---	FRONT	VERT	TOTAL	---	C1
L	29-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
M	23-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
N	21-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
O	17-7-0	-26	-26	---	FRONT	VERT	TOTAL	---	C1
P	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Q	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	19-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AC	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AD	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AE	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	19-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	25-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	27-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	31-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	33-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007660

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	T40Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:19:58 2020 Page 2
ID:DMCubINVR6TslFoe31v6l zns1l-x2qeJGBoaF2mnbccaNm9BWHeyQ8EpcGa1mZAtzME7l

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	4.0	12.0	1.00	5.50
C	TTWW+m	MT20	7.0	8.0	Edge	
D	TMWW-l	MT20	5.0	6.0		
E	TMW+w	MT20	3.0	6.0		
F	TS-l	MT20	5.0	6.0		
G	TMWW-l	MT20	5.0	6.0		
H	TTWW+m	MT20	7.0	8.0	Edge	
I	TMWV-p	MT20	4.0	12.0	1.00	5.50
K	BMV1-p	MT20	3.0	6.0		
L	BMWW-l	MT20	5.0	8.0	2.50	3.00
M	BMWW-l	MT20	5.0	8.0	2.50	3.25
N	BS-l	MT20	6.0	9.0		
O	BMWWV-l	MT20	5.0	8.0		
P	BS-l	MT20	6.0	9.0		
Q	BMWW-l	MT20	5.0	8.0	2.50	3.25
R	BMWW-l	MT20	5.0	8.0	2.50	3.00
S	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
Q	11-11-4	-28	-26	---	BACK	VERT	TOTAL	---	C1
T	13-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	15-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	16-8-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	20-8-4	-159	-159	---	BACK	VERT	TOTAL	---	C1
X	22-8-4	-159	-159	---	BACK	VERT	TOTAL	---	C1
Y	10-7-8	-1171	-1171	---	BACK	VERT	TOTAL	---	C1
Z	15-11-4	-28	-26	---	BACK	VERT	TOTAL	---	C1
AA	18-8-4	-28	-26	---	BACK	VERT	TOTAL	---	C1
AB	20-8-4	-32	-32	---	BACK	VERT	TOTAL	---	C1
AC	22-8-4	-32	-32	---	BACK	VERT	TOTAL	---	C1
AD	24-7-8	-2237	-2237	---	BACK	VERT	TOTAL	---	C1
AE	26-6-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AF	28-6-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AG	30-6-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AH	32-6-12	-121	-121	---	BACK	VERT	TOTAL	---	C1
AI	33-5-4	-121	-121	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

11 C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007661 *72*

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T41	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Apr 28 10:19:59 2020 Page 1
ID:DMCubINVR6TstFos31v6I zns11-PFO0WcCQLZAIQxtoAHu?hO3QDMnRzI?PphW7IAzME7k

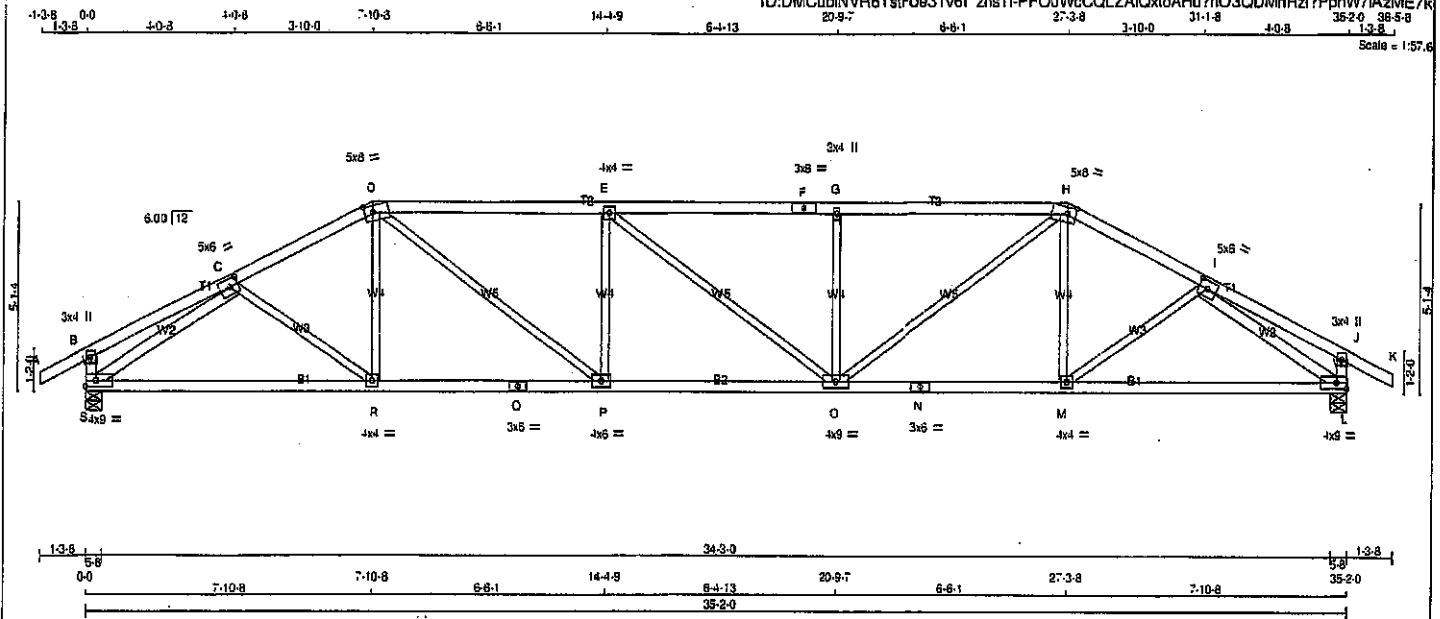

TOTAL WEIGHT = 2 X 139 = 278 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - O	2x4	DRY	No.2
O - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMV-p	3.0	4.0	
C	TMVW-1	MT20	5.0	6.0 2.50 2.75
D	TTWV-m	MT20	5.0	8.0 2.25 2.75
E	TMVW-1	MT20	4.0	4.0
F	TS-1	MT20	3.0	8.0
G	TMVW-m	MT20	2.0	4.0
H	TTWV-m	MT20	5.0	8.0 2.25 2.75
I	TMVW-1	MT20	5.0	6.0 2.50 2.75
J	TMV-p	MT20	3.0	4.0
L	BMVW-1	MT20	4.0	9.0 Edge
M	BMVW-1	MT20	4.0	4.0
N	BS-1	MT20	3.0	6.0
O	BMVW-1	MT20	4.0	9.0
P	BMVW-1	MT20	4.0	6.0
Q	BS-1	MT20	3.0	6.0
R	BMVW-1	MT20	4.0	4.0
S	BMVW-1	MT20	4.0	9.0 Edge
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.				

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
DESCR.	BEARINGS								
SPF	FACTORED		MAXIMUM FACTORED		INPUT	RECORD			
SPF	GROSS REACTION		GROSS REACTION		BRG	BRG			
SPF	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
SPF	S	2063	0	2063	0	0	5-8	5-8	
SPF	L	2063	0	2063	0	0	5-8	5-8	
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SPF									
SP									

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN PLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17')
CALCULATED VERT. DEFL. (LL) = L/999 (0.21')
ALLOWABLE DEFL. (TL) = L/360 (1.17')
CALCULATED VERT. DEFL. (TL) = L/999 (0.41')

CSI: TC=0.95/1.00 (D-E:1), BC=0.64/1.00 (O-P:1), WB=0.83/1.00 (I-L:1), SSI=0.28/1.00 (O-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1856

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (L) (INPUT = 0.90)
JSI METAL = 0.77 (N) (INPUT = 1.00)




Structural component only
DWG# T-2007662

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T42	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 MTak Industries, Inc. Tue Apr 28 10:20:31 2020 Page 1					
ID:DMCUBINVR6TstFoe31v8l_zns1HdWnxHEgtAQpFSAHixTmP8U9V?RFJG??En3zME7I					

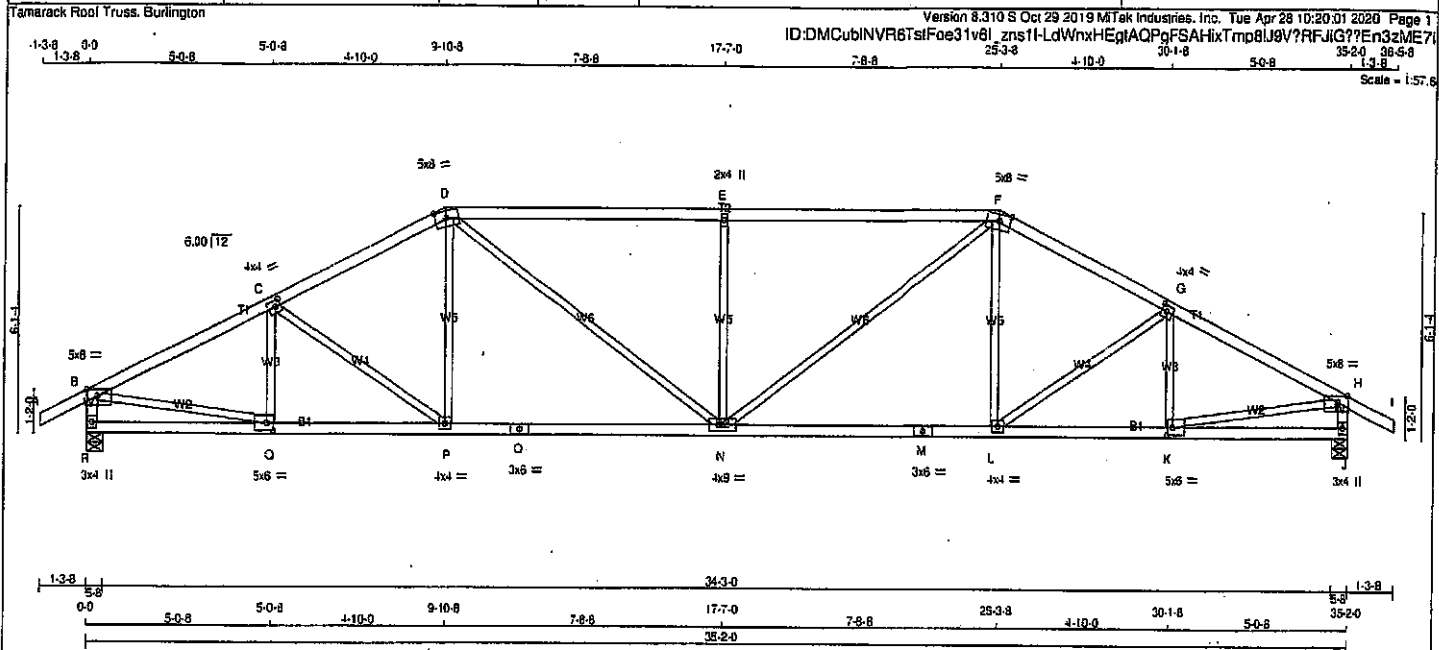


LUMBER N.L.G.A. RULES CHORDS SIZE LUMBER DESCR. A - D 2x4 DRY No.2 SPF D - F 2x4 DRY No.2 SPF F - I 2x4 DRY No.2 SPF R - B 2x4 DRY No.2 SPF J - H 2x4 DRY No.2 SPF R - O 2x4 DRY No.2 SPF O - M 2x4 DRY No.2 SPF M - J 2x4 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT DRY: SEASONED LUMBER.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED MAXIMUM FACTORED INPUT RECORD GROSS REACTION GROSS REACTION BRG BRG JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX R 2063 0 2063 0 0 5-8 5-8 J 2063 0 2063 0 0 5-8 5-8 UNFACTORED REACTIONS 1ST LCASE MAX-MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL R 1457 969 0 0 0 0 0 488 0 0 0 J 1457 969 0 0 0 0 0 488 0 0 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.78 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS WEBS MAX. FACTORED MAX. FACTORED MAX. FACTORED MEMB. FORCE VERT. LOAD LC1 MAX. MAX. MEMB. FORCE MAX. (LBS) (PLF) CSI (LC) UNBRAC LENGTH FR-TO (LBS) CSI (LC) FR-TO FROM TO A-B 0 28 -91.8 -91.8 0.12 (1) 10.00 Q-C -353 0 0.08 (1) B-C -2834 0 -91.8 -91.8 0.39 (1) 3.81 C-P -210 0 0.13 (1) C-D -2687 0 -91.8 -91.8 0.37 (1) 3.91 P-D 0 246 0.06 (4) D-E -3089 0 -91.8 -91.8 0.97 (1) 2.78 D-N 0 844 0.19 (1) E-F -3089 0 -91.8 -91.8 0.37 (1) 3.91 N-F 0 844 0.19 (1) F-G -2687 0 -91.8 -91.8 0.39 (1) 3.81 L-F 0 246 0.06 (4) G-H -2834 0 -91.8 -91.8 0.12 (1) 10.00 L-G -210 0 0.13 (1) H-I 0 28 -91.8 -91.8 0.12 (1) 10.00 K-G -353 0 0.08 (1) I-B -2018 0 0.0 0.0 0.20 (1) 5.94 K-H 0 2591 0.58 (1) J-H -2018 0 0.0 0.0 0.20 (1) 5.94 B-Q 0 2591 0.58 (1) R-Q 0 0 -18.5 -18.5 0.10 (4) 10.00 O-P 0 2555 -18.5 -18.5 0.51 (1) 10.00 P-O 0 2386 -18.5 -18.5 0.49 (1) 10.00 O-N 0 2386 -18.5 -18.5 0.49 (1) 10.00 N-M 0 2386 -18.5 -18.5 0.49 (1) 10.00 M-L 0 2386 -18.5 -18.5 0.49 (1) 10.00 L-K 0 2555 -18.5 -18.5 0.51 (1) 10.00 K-J 0 0 -18.5 -18.5 0.10 (4) 10.00				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. OC LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2018, CBC 2012, ABC 2019 - PART 9 OF CBC 2012 (2019 AMENDMENT) - CSA 086-09, CSA 086-14 - TPIC 2011, TPIC 2014 155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL. (LL) = L/360 (1.17") CALCULATED VERT. DEFL. (LL) = L/999 (0.17") ALLOWABLE DEFL. (TL) = L/360 (1.17") CALCULATED VERT. DEFL. (TL) = L/999 (0.34") CSI: TC=0.97 1.00 (D-E:1) .8C=0.51 1.00 (P-Q:1) . WB=0.58/1.00 (B-G:1) .SS=0.34/1.00 (D-E:1) DOL MEMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 1.00 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 788 1587 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP = 0.87 (F) (INPUT = 0.90) JSI METAL = 0.75 (M) (INPUT = 1.00)			
--	--	--	--	---	--	--	--	--	--	--	--

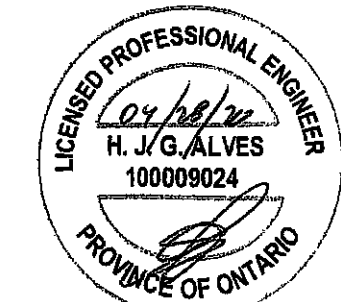

Structural component only
DWG# T-2007663

JOB NAME 408224	TRUSS NAME T43	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:20:02 2020 Page 1
ID:DMCubiNVR6TstFoe31v6l_zns1l-qp498dEieUYGHO1nQsJh7BZrVAiQsVknJVzME7h

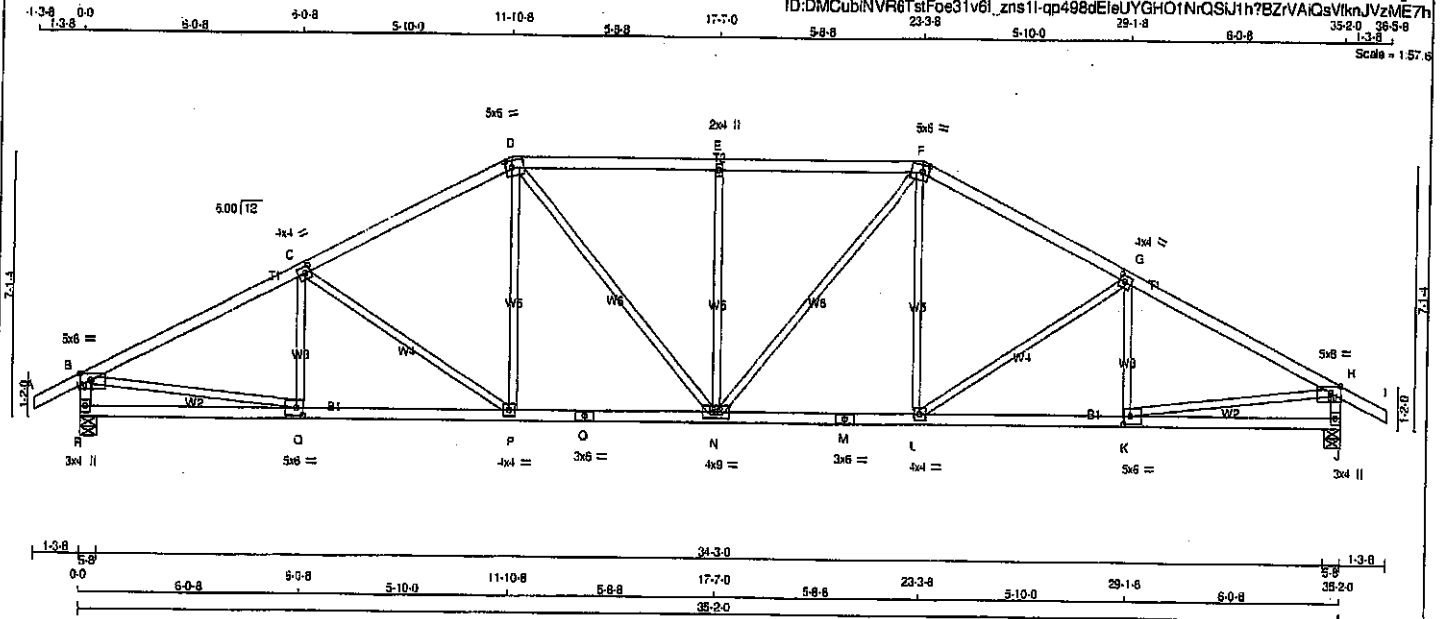

TOTAL WEIGHT = 2 X 145 = 289 lb (M/F)

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - B	2x4	DRY	No.2
B - H	2x4	DRY	No.2
H - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0	8.0 Edge 3.50
C	TMVW-t	MT20	4.0	4.0 2.00 1.75
D	TTVW-m	MT20	5.0	6.0 2.25 2.00
E	TMVW-w	MT20	2.0	4.0
F	TTVW-m	MT20	5.0	6.0 2.25 2.00
G	TMVW-t	MT20	4.0	4.0 2.00 1.75
H	TMVW-p	MT20	5.0	8.0 Edge 3.50
J	BMV1+p	MT20	3.0	4.0
K	BMVW-t	MT20	5.0	6.0 2.50 2.25
L	BMVW-t	MT20	4.0	4.0
M	BS-t	MT20	3.0	6.0
N	BMVW-t	MT20	4.0	8.0
O	BS-t	MT20	3.0	6.0
P	BMVW-t	MT20	4.0	4.0
Q	BMVW-t	MT20	5.0	6.0 2.50 2.25
R	BMV1+p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	VERT	HORZ	DOWN	HORZ	UP	IN-SX	BRG	IN-SX
R	2063	0	0	2063	0	0	5-8	5-8	5-8
J	2063	0	0	2063	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST LC CASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
R	1457	999	0	0	0
J	1457	999	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)	
CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0 28	A-B	-255 12
B-C	-2889 0	B-C	-435 0
C-D	-2539 0	C-D	0 350
D-E	-2559 0	D-E	0 462
E-F	-2559 0	E-F	-641 0
F-G	-2839 0	F-G	0 482
G-H	-2889 0	G-H	0 350
H-I	0 28	H-I	-435 0
I-J	-2014 0	I-J	-255 12
J-K	-2014 0	J-K	0 2635
K-L	0 0	K-L	0 2635
L-M	0 0	L-M	0 2635
M-N	0 2609	M-N	0 2635
N-O	0 2249	N-O	0 2635
O-P	0 2249	O-P	0 2635
P-Q	0 2249	P-Q	0 2635
Q-R	0 2249	Q-R	0 2635
R-S	0 2249	R-S	0 2635
S-T	0 2249	S-T	0 2635
T-U	0 2249	T-U	0 2635
U-V	0 2249	U-V	0 2635
V-W	0 2249	V-W	0 2635
W-X	0 2249	W-X	0 2635
X-Y	0 2249	X-Y	0 2635
Y-Z	0 2249	Y-Z	0 2635
Z-A	0 2249	Z-A	0 2635

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSK TC=0.58/1.00 (G-H:1), BC=0.49/1.00 (K-L:1), WB=0.59/1.00 (H-K:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.89 (Q) (INPUT = 0.90)
JSI METAL=0.69 (M) (INPUT = 1.00)

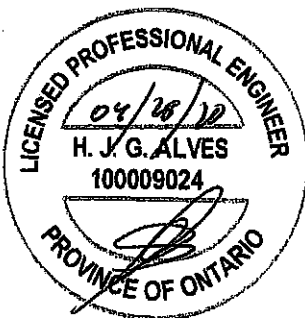

Structural component only
DWG# T-2007664

JOB NAME 408224	TRUSS NAME T44	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 MTK Industries, Inc. Tue Apr 28 10:20:33 2020 Page 1					
ID:DMCub\NVR6Tst\Foe31vbl zns1H0dXmZFWoag7vYcZP7zxsEE72zACV9c7KJUKrxzME7g					
Scale = 1:50.3					

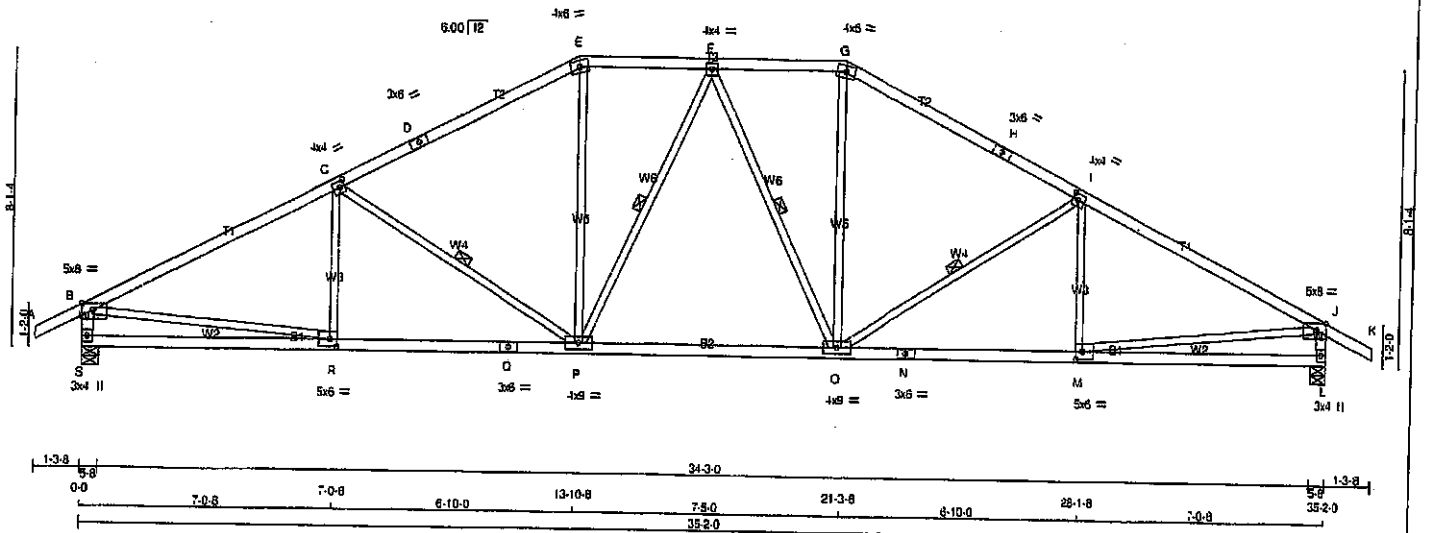

LUMBER					DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										TOTAL WEIGHT = 2 X 145 = 291 lb				
N. L. G. A. RULES					BEARINGS					DESIGN CRITERIA					(M/F)				
CHORDS					FACTORED					SPECIFIED LOADS:									
SIZE					GROSS REACTION					TOP CH. LL = 25.6 PSF									
LUMBER					GROSS REACTION					DL = 8.0 PSF									
DESCR.					DOWN					BQT CH. LL = 0.0 PSF									
A - D					UPLIFT					DL = 7.4 PSF									
D - E					IN-SX					TOTAL LOAD = 39.0 PSF									
E - G					IN-SX					SPACING = 24.0 IN. C/C									
G - H										LOADING IN FLAT SECTION BASED ON A SLOPE									
H - K										OF 6.00/12									
K - L										THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR									
L - J																			
J - O																			
O - N																			
N - L																			
ALL WEBS EXCEPT																			
DRY: SEASONED LUMBER.																			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMWW-p	MT20	5.0	8.0 Edge 3.50
C	TMWW-t	MT20	4.0	4.0 2.00 1.75
D	TS-t	MT20	3.0	6.0
E	TTW-m	MT20	4.0	6.0
F	TMWW-t	MT20	4.0	4.0
G	TTW-m	MT20	4.0	6.0
H	TS-t	MT20	3.0	6.0
I	TMWW-t	MT20	4.0	4.0 2.00 1.75
J	TMWW-p	MT20	5.0	8.0 Edge 3.50
L	BMVt-p	MT20	3.0	4.0
M	BMWW-t	MT20	5.0	6.0 2.50 2.25
N	BS-t	MT20	3.0	6.0
O	BMWW-t	MT20	4.0	9.0
P	BMWW-t	MT20	4.0	9.0
Q	BS-t	MT20	3.0	6.0
R	BMWW-t	MT20	5.0	6.0 2.50 2.25
S	BMVt-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.
I LATERAL BRACE(S) AT 1/2 LENGTH OF C-P, F-P, F-D, I-O.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING				TOTAL LOAD CASES: (4)			
CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (L)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO	A-B	0	28	-91.8	FR-TO	R-C	-182
B-C	-2906	0	-91.8	-91.8	C-P	-637	0
C-D	-2373	0	-91.8	-91.8	P-E	0	674
D-E	-2373	0	-91.8	-91.8	F-F	-222	0
E-F	-2100	0	-91.8	-91.8	F-O	-222	0
F-G	-2100	0	-91.8	-91.8	O-G	0	674
G-H	-2373	0	-91.8	-91.8	O-I	-637	0
H-I	-2373	0	-91.8	-91.8	I-I	-182	52
I-J	-2906	0	-91.8	-91.8	B-R	0	2649
J-K	0	28	-91.8	-91.8	M-J	0	2649
S-B	-2008	0	0.0	0.0			
L-J	-2008	0	0.0	0.0			
S-R	0	0	-18.5	-18.5			
R-O	0	2630	-18.5	-18.5			
O-P	0	2630	-18.5	-18.5			
P-O	0	2183	-18.5	-18.5			
O-N	0	2630	-18.5	-18.5			
N-M	0	2630	-18.5	-18.5			
M-L	0	0	-18.5	-18.5			

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

65% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CSI: TC=0.83/1.00 (I-J:1), BC=0.52/1.00 (M-O:1)
WB=0.60/1.00 (J-M:1), SI=0.28/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (M) (INPUT = 0.80)
JSI METAL = 0.79 (Q) (INPUT = 1.00)




Structural component only
DWG# T-2007665

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T45	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:28:04 2020 Page 1
ID:DMCubINVR6TsIFoe31v8I_zns11-mCBvZJGY85o_XIBIzUBOSmOWNWqcd9yyDuNOzME7I

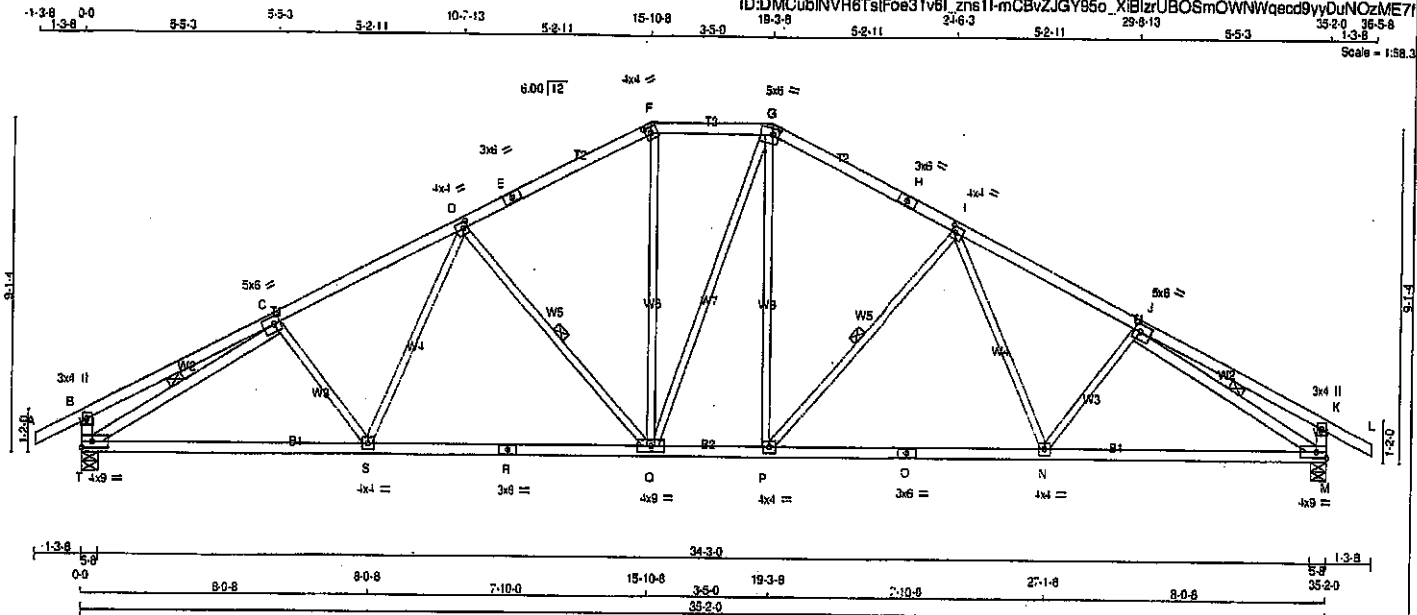

TOTAL WEIGHT = 2 X 155 = 310 lb
(M/F)

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
J - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - N	2x4	DRY	No.2
N - O	2x4	DRY	No.2
O - P	2x4	DRY	No.2
P - Q	2x4	DRY	No.2
Q - R	2x4	DRY	No.2
R - S	2x4	DRY	No.2
S - T	2x4	DRY	No.2
T - U	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
T - C	2x4	DRY	No.2
J - M	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV-vp	MT20	3.0	4.0	
C	TMV-vp	MT20	5.0	6.0	2.50 2.25
D	TMV-vp	MT20	4.0	4.0	2.00 1.50
E	TS-1	MT20	3.0	6.0	
F	TTW-h	MT20	4.0	4.0	2.00 1.75
G	TTW-m	MT20	5.0	6.0	2.00 2.00
H	TS-1	MT20	3.0	6.0	
I	TMV-vp	MT20	4.0	4.0	2.00 1.50
J	TMV-vp	MT20	5.0	6.0	2.50 2.25
K	TMV-vp	MT20	3.0	4.0	
M	BMVW-1	MT20	4.0	9.0	Edge
N, P, S					
N	BMVW-1	MT20	4.0	4.0	
O	BS-1	MT20	3.0	6.0	
Q	BMVW-1	MT20	4.0	9.0	
R	BS-1	MT20	3.0	6.0	
T	BMVW-1	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQ'D
	GROSS REACTION		GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
T	2063	0	2063	0	0	5-8	5-8
M	2063	0	2063	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
T	1457	969 0	0 0	0 0	0 0	488 0	0 0
M	1457	969 0	0 0	0 0	0 0	488 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-Q, I-P, C-T, J-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: 14)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	MAX. CS (LC)
FR-TO		FROM TO		FR-TO			
A-B	0 28	-91.8 -91.8	0.12 (1)	10.00	C-S	-110 37	0.04 (1)
B-C	0 20	-91.8 -91.8	0.32 (1)	10.00	S-D	0 276	0.08 (1)
C-D	-2760 0	-91.8 -91.8	0.40 (1)	3.86	D-Q	-692 0	0.31 (1)
D-E	-2167 0	-91.8 -91.8	0.36 (1)	4.30	Q-F	0 614	0.14 (1)
E-F	-2167 0	-91.8 -91.8	0.36 (1)	4.30	F-G	0 4	0.00 (1)
F-G	-1925 0	-91.8 -91.8	0.18 (1)	4.71	G-H	0 609	0.14 (1)
G-H	-2165 0	-91.8 -91.8	0.36 (1)	4.30	H-I	-683 0	0.31 (1)
H-I	-2165 0	-91.8 -91.8	0.36 (1)	4.30	I-N	0 279	0.06 (1)
I-J	-2761 0	-91.8 -91.8	0.40 (1)	3.86	N-J	-110 37	0.04 (1)
J-K	0 20	-91.8 -91.8	0.32 (1)	10.00	T-C	-3042 0	0.81 (1)
K-L	0 28	-91.8 -91.8	0.12 (1)	10.00	J-M	-3043 0	0.81 (1)
T-B	-325 0	0.0 0.0	0.03 (1)	7.61			
M-K	-325 0	0.0 0.0	0.03 (1)	7.61			
T-S	0 2537	-18.5 -18.5	0.56 (1)	10.00			
S-R	0 2363	-18.5 -18.5	0.53 (1)	10.00			
R-Q	0 2363	-18.5 -18.5	0.53 (1)	10.00			
Q-P	0 1924	-18.5 -18.5	0.40 (1)	10.00			
P-O	0 2362	-18.5 -18.5	0.53 (1)	10.00			
O-N	0 2362	-18.5 -18.5	0.53 (1)	10.00			
N-M	0 2538	-18.5 -18.5	0.56 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CSI: TC=0.40; 1.00 (I-J); BC=0.58; 1.00 (M-N); WB=0.61; 1.00 (J-M); SS=0.20; 1.00 (G-I)

DOL LUMBER=1.00 NAIL=1.00 LB SEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (F) (INPUT = 0.90)
JSI METAL = 0.83 (O) (INPUT = 1.00)

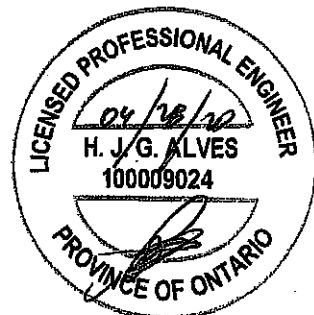


Structural component only
DWG# T-2007666

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T46	8	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MitTek Industries, Inc. Tue Apr 28 10:20:05 2020 Page 1
ID:DMCubINVR6TstF0e31v6I_znsf1EOlnHBwPw9smyWY?QxUjYonsaN171BczRwqzME7e

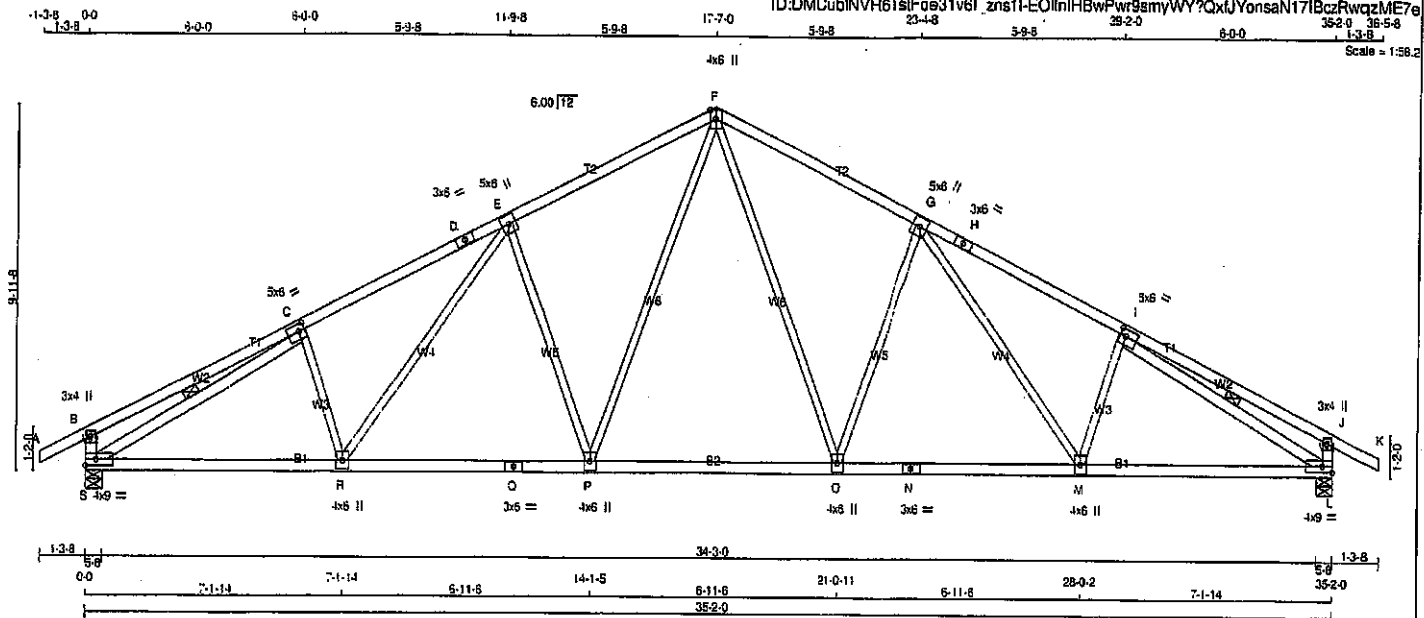

TOTAL WEIGHT = 8 X 152 = 1213 lb

LUMBER	N L G A RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - K	2x4	DRY	No.2	SPF	
S - B	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
S - O	2x4	DRY	No.2	SPF	
O - N	2x4	DRY	No.2	SPF	
N - L	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
S - C	2x4	DRY	No.2	SPF	
I - L	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-i	MT20	5.0	8.0	2.25	2.00
D	TS-i	MT20	3.0	6.0		
E	TMWW-i	MT20	5.0	8.0		
F	TTWW+p	MT20	4.0	8.0	Edge	
G	TMWW-i	MT20	5.0	8.0		
H	TS-i	MT20	3.0	6.0		
I	TMWW-i	MT20	5.0	8.0	2.25	2.00
J	TMV+p	MT20	3.0	4.0		
L	BMVW1-i	MT20	4.0	9.0	Edge	
M, O, P, R						
M	BMWW-H	MT20	4.0	8.0		
N	BS-i	MT20	3.0	6.0		
O	BS-i	MT20	3.0	6.0		
S	BMVW1-i	MT20	4.0	9.0	Edge	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
S	2063	0	2063	0	0	5-8	5-8
L	2063	0	2063	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED						
S	1457	969	0	0	0	0	0
L	1457	969	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORZ. LOAD (LBS)
FR-TO						FR-TO			
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00	F-O	0	866
B-C	0	22	-91.8	-91.8	0.40 (1)	10.00	O-G	-726	0
C-D	-2808	0	-91.8	-91.8	0.49 (1)	3.75	G-M	0	391
D-E	-2808	0	-91.8	-91.8	0.49 (1)	3.75	M-I	-192	18
E-F	-2322	0	-91.8	-91.8	0.46 (1)	4.07	P-F	0	866
F-G	-2322	0	-91.8	-91.8	0.46 (1)	4.07	E-P	-726	0
G-H	-2808	0	-91.8	-91.8	0.49 (1)	3.75	R-E	0	391
H-I	-2808	0	-91.8	-91.8	0.49 (1)	3.75	C-R	-192	18
I-J	0	22	-91.8	-91.8	0.40 (1)	10.00	S-C	-3084	0
J-K	0	28	-91.8	-91.8	0.12 (1)	10.00	I-L	-3084	0
S-B	-344	0	0.0	0.0	0.03 (1)	7.81			
L-J	-344	0	0.0	0.0	0.03 (1)	7.81			
S-R	0	2574	-18.5	-18.5	0.53 (1)	10.00			
R-O	0	2291	-18.5	-18.5	0.47 (1)	10.00			
O-P	0	2291	-18.5	-18.5	0.47 (1)	10.00			
P-O	0	1762	-18.5	-18.5	0.36 (1)	10.00			
O-N	0	2291	-18.5	-18.5	0.47 (1)	10.00			
N-M	0	2291	-18.5	-18.5	0.47 (1)	10.00			
M-L	0	2574	-18.5	-18.5	0.53 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17')
CALCULATED VERT. DEFL. (LL) = L/999 (0.14')
ALLOWABLE DEFL. (TL) = L/360 (1.17')
CALCULATED VERT. DEFL. (TL) = L/999 (0.28')

CSI: TC=0.49/1.00 (C-E:1), BC=0.53/1.00 (L-M:1),
WB=0.72/1.00 (E-P:1), SS=0.22/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (C) (INPUT = 0.90)
JSI METAL = 0.77 (I) (INPUT = 1.00)

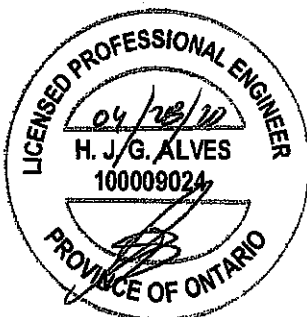


Structural component only
DWG# T-2007667

JOB NAME 408224	TRUSS NAME T47S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 3.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:20:06 2020 Page 1
ID:DMCubINVR6TstFoe31v6l zns11-bJq_?Hph12m0K84GWITsngADw8c_RQGi_SGzME7d

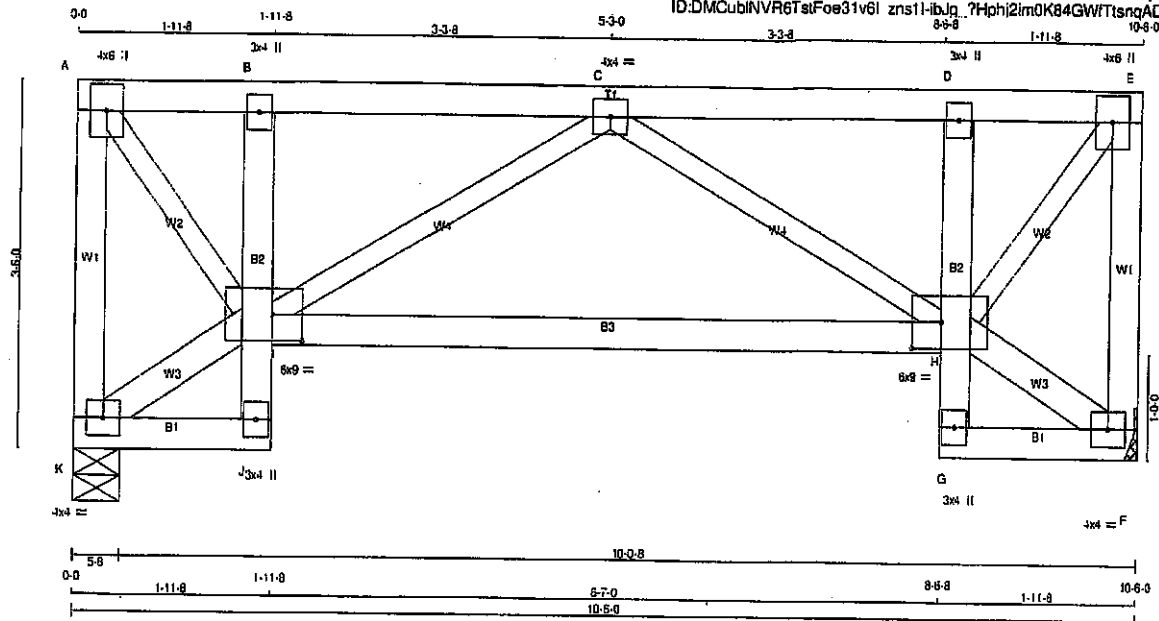

Scale = 1:20.3

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
K - A	2x4	DRY	No.2
A - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
K - J	2x4	DRY	No.2
J - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
G - D	2x4	DRY	No.2
G - F	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
K - I	2x4	DRY	No.2
H - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	8.0		
B	TMV+p	MT20	3.0	4.0		
C	TMVWV-l	MT20	4.0	4.0		
D	TMV+p	MT20	3.0	4.0		
E	TMVW+p	MT20	4.0	6.0		
F	BMVW-l	MT20	4.0	4.0		
G	BMV+p	MT20	3.0	4.0		
H	BVMWVW-l	MT20	6.0	9.0	3.00	3.50
I	BVMWVW-l	MT20	6.0	9.0	3.00	3.50
J	BMV+p	MT20	3.0	4.0		
K	BMVW-l	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
K	697	0	697	0
F	697	0	697	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
K	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	504	289	0	0	0	235	0
F	504	289	0	0	0	235	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.61 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO		FR-TO			
K-A	-667 0	0.0	0.0 0.17 (1)	7.81	K-I	-28 0 0.00 (1)	
A-B	-497 0	-114.3	-114.3 0.14 (1)	6.25	A-I	0 783 0.24 (1)	
B-C	-508 0	-114.3	-114.3 0.22 (1)	6.25	H-F	-28 0 0.00 (1)	
C-D	-508 0	-114.3	-114.3 0.22 (1)	8.25	H-E	0 783 0.24 (1)	
D-E	-497 0	-114.3	-114.3 0.14 (1)	6.25	I-C	-384 0 0.15 (1)	
E-F	-667 0	0.0	0.0 0.17 (1)	7.81	C-H	-384 0 0.15 (1)	
K-J	0 25	-18.5	-18.5 0.03 (4)	10.00			
J-I	0 19	0.0	0.0 0.05 (1)	10.00			
I-B	-331 0	0.0	0.0 0.05 (1)	7.61			
I-H	0 832	-18.5	-18.5 0.46 (4)	10.00			
G-H	0 19	0.0	0.0 0.05 (1)	10.00			
H-D	-331 0	0.0	0.0 0.05 (1)	7.61			
G-F	0 25	-18.5	-18.5 0.03 (4)	10.00			

TOTAL WEIGHT = 2 X 51 = 102 lb [M/R]

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	15.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	48.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 086-14
- TPIC 2011, TPIC 2014

65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.35")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.35")
CALCULATED VERT. DEFL. (TL) = L/999 (0.12")

CSI: TC=0.22/1.00 (B-C-1), BC=0.46/1.00 (H-I-4), WB=0.24/1.00 (E-H-1), SS=0.22/1.00 (B-C-1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618	354
	1667	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.77 (H) INPUT = 0.90
JSI METAL = 0.30 (E) INPUT = 1.00

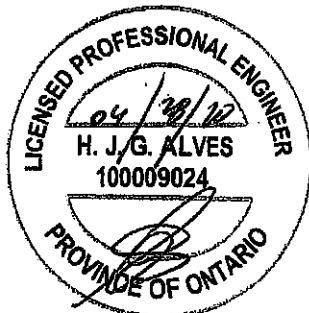

Structural component only
DWG# T-2007668

Version 8.310 S Oct 29 2019 M/Tek Industries, Inc. Tue Apr 26 10:20:37 2020 Page 1
ID:DMCubiNVR6TstFoe31v6I zns11-Ani2CLIRS0AZOAvKaz1u04OyjadNr3HbfvSY jzME7c
1-3-8 0-0 3-0-0 3-7-12 3-9-8 10-5-0
1-3-8 6-7-12 6-9-8 0-12 3-9-8 10-5-0
Scale = 1:10

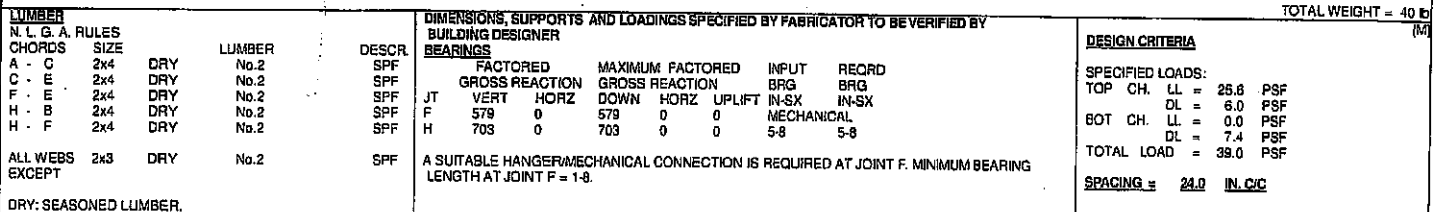

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER						
<u>BEARINGS</u>						
	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQ'D BRG
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX
JT	579	0	579	0	0	MECHANICAL
H	703	0	703	0	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS							
1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	409	269 0	0 0	0 0	0 0	141 0	0 0
H	495	338 0	0 0	0 0	0 0	157 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS				WEBS					
MAX. FACTORED		FACTORED		MAX. FACTORED		MAX. FACTORED		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX. CSI (LC)	MEMB.	FORCE (LBS)
FR-TO		FROM	TO		FR-TO			FR-TO	
A-B	0	-91.8	-91.8	0.12 (1)	10.00	G-C	0	61	0.02 (4)
B-C	-835	0	-91.8	-91.8	0.15 (1)	6.25	G-D	-61	90
C-D	-589	0	-91.8	-91.8	0.21 (1)	8.25	D-F	-731	0
D-E	0	-91.8	-91.8	0.20 (1)	10.00	B-G	0	587	0.13 (1)
E-F	-135	0	0.0	0.0	0.02 (1)	7.81			
F-B	-689	0	0.0	0.0	0.07 (1)	7.81			
H-G	0	-18.5	-18.5	0.21 (4)	10.00				
G-F	0	-18.5	-18.5	0.28 (4)	10.00				


JOB NAME 408224	TRUSS NAME T49	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:20:08 2020 Page 1

ID:DMCubINVR6TstFoe31v6I_zns11-ezRQPhJ3DKIQ0JUWCqZ7Zlx3M_zfaUMktaB5V9zME7b

Scale = 1:22.0

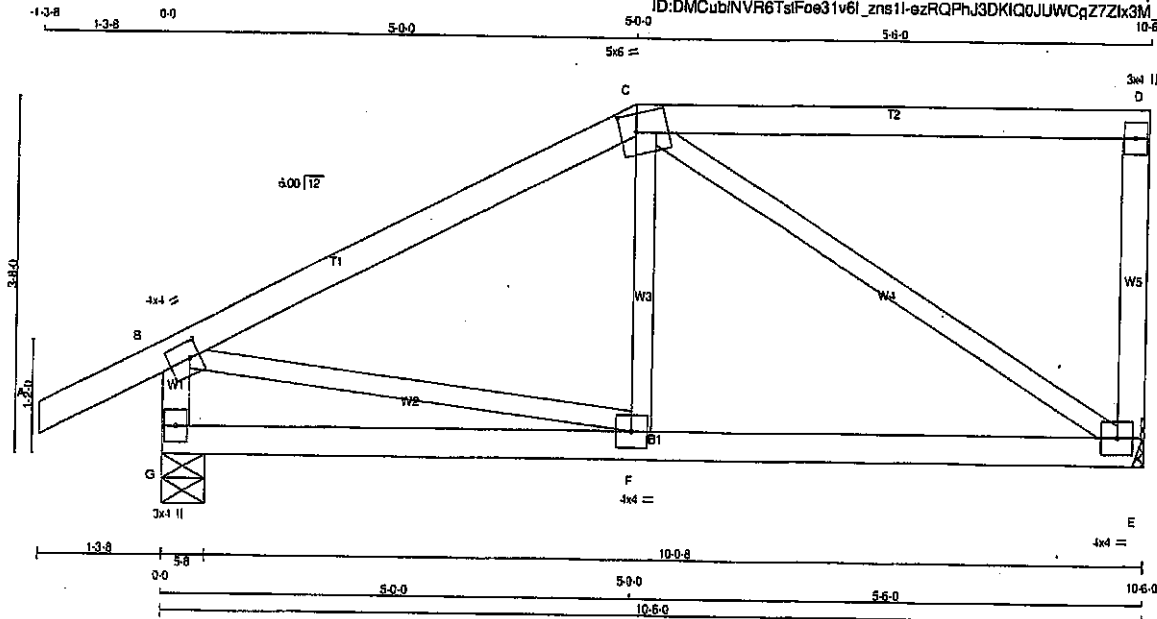

TOTAL WEIGHT = 42 lb
(10)

LUMBER			
N.L.G.A. RULES	SIZE	DRY	LUMBER
CHORDS	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
G - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-t	MT20	4.0	4.0	2.00	1.25
C TTWW-m	MT20	5.0	6.0	2.25	2.00
D TMVW-p	MT20	3.0	4.0		
E BMVW-t	MT20	4.0	4.0		
F BMVW-l	MT20	4.0	4.0		
G BMV-t+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT HORZ	DOWN HORZ UPLIFT	IN-SX	IN-SX
JT 579 0	579 0 0	MECHANICAL	
E 703 0	703 0 0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS						
JT COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
E 409	268 0	0 0	0 0	0 0	141 0	0 0	
G 495	338 0	0 0	0 0	0 0	157 0	0 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 28	-91.8 -91.8	0.12 (1)	10.00	F-C	0 106	0.04 (4)
B-C	-523 0	-91.8 -91.8	0.41 (1)	8.25	C-E	-549 0	0.37 (11)
C-D	0 0	-91.8 -91.8	0.47 (1)	10.00	B-F	0 474	0.11 (11)
E-D	-252 0	0.0 0.0	0.05 (1)	7.81			
G-B	-667 0	0.0 0.0	0.07 (1)	7.81			
G-F	0 0	-18.5 -18.5	0.14 (4)	10.00			
F-E	0 468	-18.5 -18.5	0.19 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.47 1.00 (C-D:1), BC=0.19/1.00 (E-F:4), WB=0.37 1.00 (C-E:1), SSI=0.20/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR SECTION (PSD)	(PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667	788	1987


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.85 (B) (INPUT = 0.90)
JSI METAL = 0.26 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007670

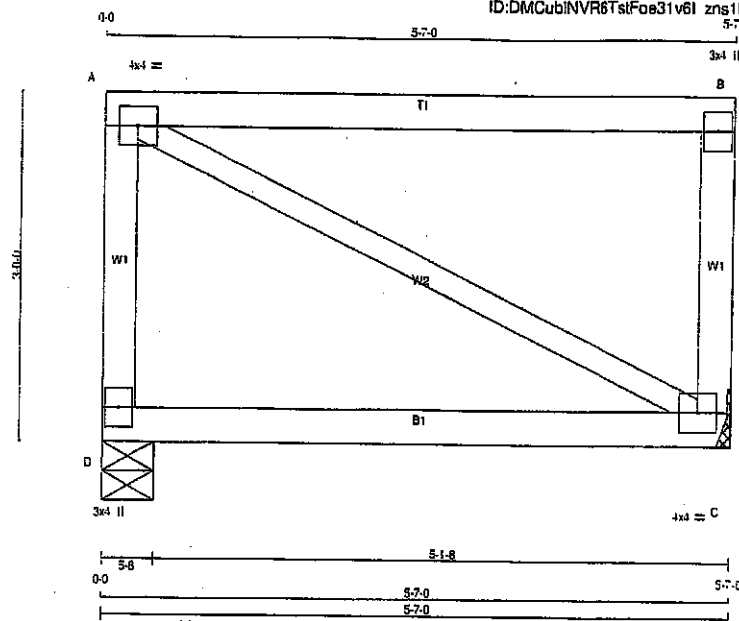

TOTAL WEIGHT = 2 X 23 = 46 lb
(M)(R)

LUMBER			
N. L. G. A. RULES			
CHOADS		SIZE	LUMBER
D - A	2x4	DRY	No.2
A - B	2x4	DRY	No.2
C - B	2x4	DRY	No.2
D - C	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER			

PLATES (tablets in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	4.0	4.0		
B	TMV+p	MT20	3.0	4.0		
C	BMVW-1	MT20	4.0	4.0		
D	BMV+1	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
D	371	0	371	0	0	5-8	5-8
C	371	0	371	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT C. MINIMUM BEARING LENGTH AT JOINT C = 1-8.

UNFACTORED REACTIONS

1ST CASE		MAX-MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	268	143 0	0 0	0 0	0 0	125 0	0 0
C	268	143 0	0 0	0 0	0 0	125 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: {4}

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LBS)	MAX. UNBRAC. LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	LC1 MAX. CSI (LBS)		
FR-TO		FROM TO			FR-TO				
D-A	-319 0	0.0 0.0	0.06 (1)	7.81					
A-B	0 0	-114.3 -114.3	0.81 (1)	10.00	A-C	0 0	0.00 (1)		
C-B	-319 0	0.0 0.0	0.06 (1)	7.81					
D-C	0 0	-18.5 -18.5	0.23 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	15.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD		=	48.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBG 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

$$\text{ALLOWABLE DEFL. (TL)} = L/360 = 10.19"$$

CALCULATED VERT. DEFL.(TL) = 1.999 (0.04")

CSI: $TC=0.81/1.00$ (A-B:1), $BC=0.23/1.00$ (C-D:4),
WB=0.00/1.00 (A-C:1), SSI=0.33/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.25 | A | INPUT = 1.90 |


JSI METAL= 0.07 (A) {INPUT = 1.00 1



Structural component only
DWG# T-2007671

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	G50	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 3.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:19:51 2020 Page 1
ID:DMCubINVR8TstFoe31v8f zns1l-eiv7r18OD69qTihFic7MikFo7CC5i2EzRaiQezME7s

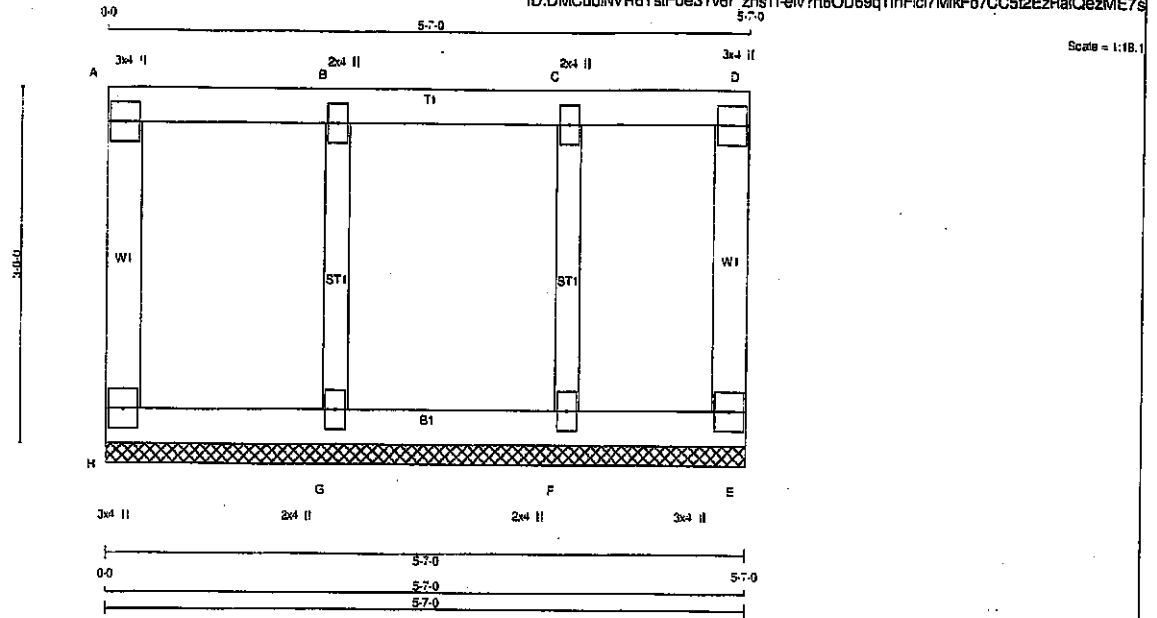

TOTAL WEIGHT = 22 lb
(M/R)

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
H - A	2x4	DRY	No.2
A - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
H - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2'-0" O.C.

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMV+p	MT20	3.0	4.0	
B	TMW+w	MT20	2.0	4.0	
C	TMW+w	MT20	2.0	4.0	
D	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	
F	BMW1+w	MT20	2.0	4.0	
G	BMW1+w	MT20	2.0	4.0	
H	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING.

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	UNBRACED LENGTH
FR-TO		FROM TO		FR-TO			
H-A	-101 0	0.0 0.0 0.03 (1)	7.81	G-B	-248 0	0.08 (1)	
A-B	-8 0	-114.3 -114.3 0.08 (1)	10.00	F-C	-209 0	0.05 (1)	
B-C	-8 0	-114.3 -114.3 0.08 (1)	10.00				
C-D	-8 0	-114.3 -114.3 0.08 (1)	10.00				
E-D	-80 0	0.0 0.0 0.03 (1)	7.81				
H-G	0 8	-18.5 -18.5 0.02 (4)	10.00				
G-F	0 8	-18.5 -18.5 0.02 (4)	10.00				
F-E	0 8	-18.5 -18.5 0.02 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 15.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 48.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.08/1.00 (A-B:1), SC=0.02/1.00 (G-H:1), WB=0.08/1.00 (B-G:1), SSI=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1997 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.17 (G) (INPUT = 0.90)
JSI METAL = 0.07 (G) (INPUT = 1.00)



Structural component only
DWG# T-2007656

JOB NAME 408224	TRUSS NAME T51	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

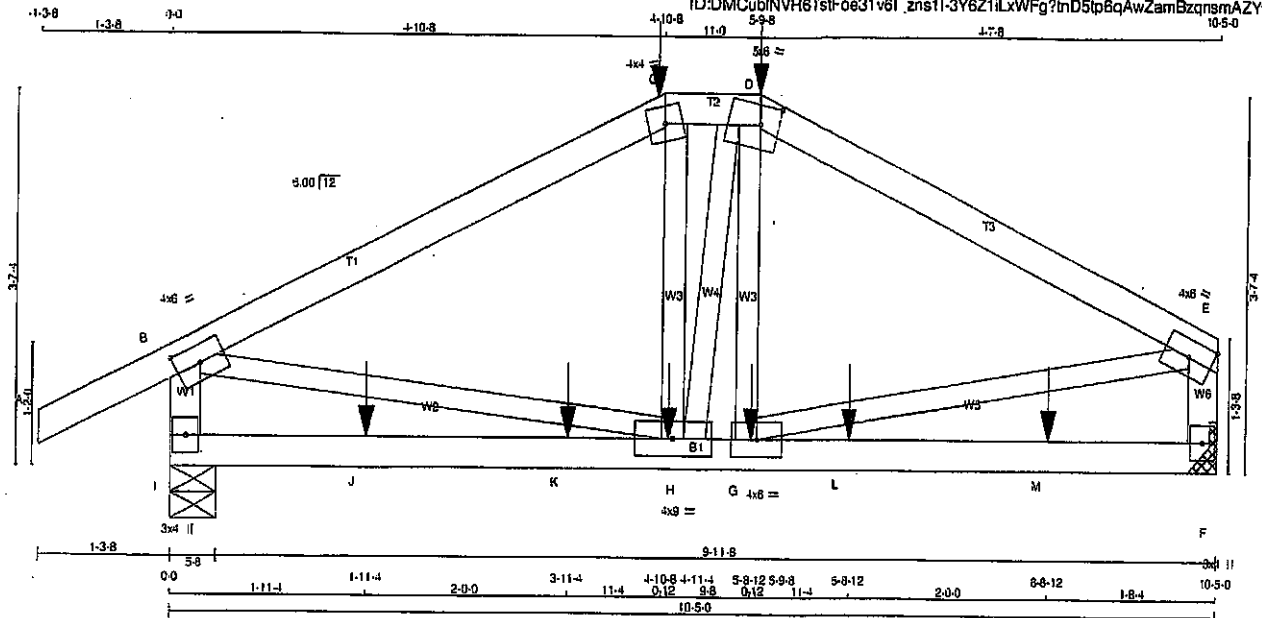

Scale = 1/20

TOTAL WEIGHT = 44 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
I - S	2x4	DRY	No.2
F - E	2x4	DRY	No.2
I - F	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	6.0	2.00	3.00
C	TTW-m	MT20	4.0	4.0		
D	TTWW-m	MT20	5.0	6.0	2.25	2.25
E	TMVW-t	MT20	4.0	6.0		Edge
F	BMV1+p	MT20	3.0	4.0		
G	BMWW-t	MT20	4.0	6.0		
H	BMWW-t	MT20	4.0	9.0		
I	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN - HORZ	UPLIFT IN-SX	IN-SX
I	1104	0	1104	0	5-8
F	1000	0	1000	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3'-8".

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	778	525	0	0	0	253	0
F	707	465	0	0	0	242	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.22 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: 14)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED (LC1)	MEMB.	FORCE (LBS)	MAX. FACTORED (LC1)	
FR-TO				FR-TO			
A-B	0	28	-91.8	H-C	-99	54	0.02 (1)
B-C	-1177	0	-91.8	H-D	0	30	0.01 (4)
C-D	-1045	0	-91.8	G-D	-120	24	0.03 (1)
D-E	-1167	0	-91.8	B-H	0	1067	0.26 (1)
E-F	-1053	0	0.0	G-E	0	1066	0.26 (1)
F-E	-953	0	0.0				
I-J	0	0	-18.5				
J-K	0	0	-18.5				
K-H	0	0	-18.5				
H-G	0	1039	-18.5				
G-L	0	0	-18.5				
L-M	0	0	-18.5				
M-F	0	0	-18.5				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC	LC1	MAX	MAX	FACE	DIR	TYPE	HEEL	CONN.
C	4-10-8	361	-361	---	FRONT	VERT	TOTAL	---	C1
D	5-8-8	361	-361	---	FRONT	VERT	TOTAL	---	C1
G	5-8-12	-19	-19	---	FRONT	VERT	TOTAL	---	C1
H	4-11-4	-19	-19	---	FRONT	VERT	TOTAL	---	C1
J	1-11-4	-17	-18	---	FRONT	VERT	TOTAL	---	C1
K	3-11-4	-19	-19	---	FRONT	VERT	TOTAL	---	C1
L	6-8-12	-19	-19	---	FRONT	VERT	TOTAL	---	C1
M	8-8-12	-17	-18	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	OL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	OL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, CBC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.35")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.35")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSI: TC=0.48/1.00 (B-C:1), BC=0.28/1.00 (G-H:4)
WB=0.25/1.00 (B-H:1), SSI=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PL)	SECTION (PL)
MT20	618	354	1687

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.71 (G) (INPUT = 0.90)
JSI METAL = 0.33 (B) (INPUT = 1.00)

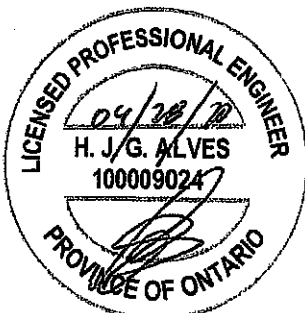


Structural component only
DWG# T-2007672

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	T52	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:20:12 2020 Page 1
ID:DMCubINVR6TsFoe31v6t_zns11-XlqxF2MaH2psUxoIRWd3j86qEbM8WMgKcC9JfwzME7X

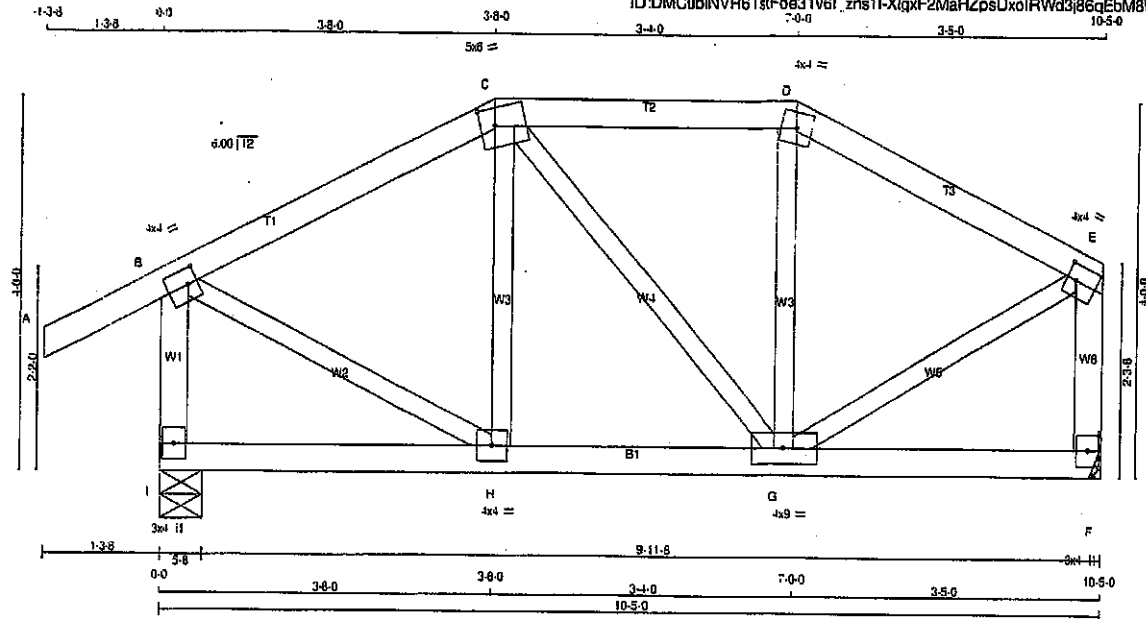

TOTAL WEIGHT = 46 lb
(M/F)

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
G - H	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-I	MT20	4.0	4.0	2.00	1.25
C	TTWW-m	MT20	5.0	6.0	2.25	2.00
D	TTWW-m	MT20	4.0	4.0		
E	TMVW-I	MT20	4.0	4.0	2.00	1.25
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-I	MT20	4.0	9.0		
H	BMVWW-I	MT20	4.0	4.0		
I	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORIZ	UPLIFT
I	699	0	0	5-8
F	574	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	492	336 0	0 0	0 0	0 0	156 0	0 0
F	408	267 0	0 0	0 0	0 0	140 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED		MEMB.	MAX. FACTORED		
	FORCE	VERT. LOAD	LC1 MAX		FORCE	MAX	
	(LBS)	(PLF)	CSI (LC)		(LBS)	CSI (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 25	-91.8	-91.8 0.12 (1)	10.00	H-C	-116 14	0.03 (1)
B-C	-423 0	-91.8	-91.8 0.16 (1)	6.25	C-G	-20 0	0.01 (1)
C-D	-362 0	-91.8	-91.8 0.13 (1)	8.25	G-D	-126 8	0.03 (1)
D-E	-409 0	-91.8	-91.8 0.14 (1)	8.25	B-H	0 422	0.08 (1)
E-F	-669 0	0.0	0.0 0.08 (1)	7.81	G-E	0 419	0.09 (1)
F-G	-546 0	0.0	0.0 0.07 (1)	7.81			
I-H	0 0	-18.5	-18.5 0.05 (4)	10.00			
H-G	0 375	-18.5	-18.5 0.09 (1)	10.00			
G-F	0 0	-18.5	-18.5 0.05 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
DL = 8.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD = 39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.35")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.35")
CALCULATED VERT. DEFL. (TL) = L/999 (0.01")

CSI: TC=0.15/1.00 (B-C:1), BC=0.09/1.00 (G-H:1), WB=0.09/1.00 (B-H:1), SS=0.12/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (D)	SHEAR	SECTION
(PS)	(PL)	(PL)	
MAX	MIN	MAX	MIN
MT20	618	354	1867 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.65 (B) (INPUT = 0.90)
JSI METAL = 0.21 (B) (INPUT = 1.00)

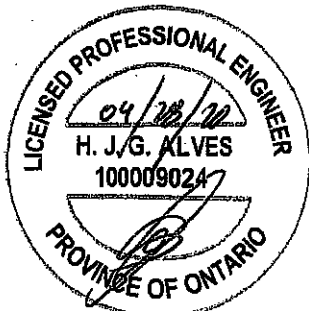


Structural component only
DWG# T-2007673

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T53	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Tue Apr 26 10:20:13 2020 Page 1
ID:DMCubINVR6TstFos31v6I zns1i-7xEJSONC2sx65NU_E8IGLazS7HFOFT1sveCMzME7W

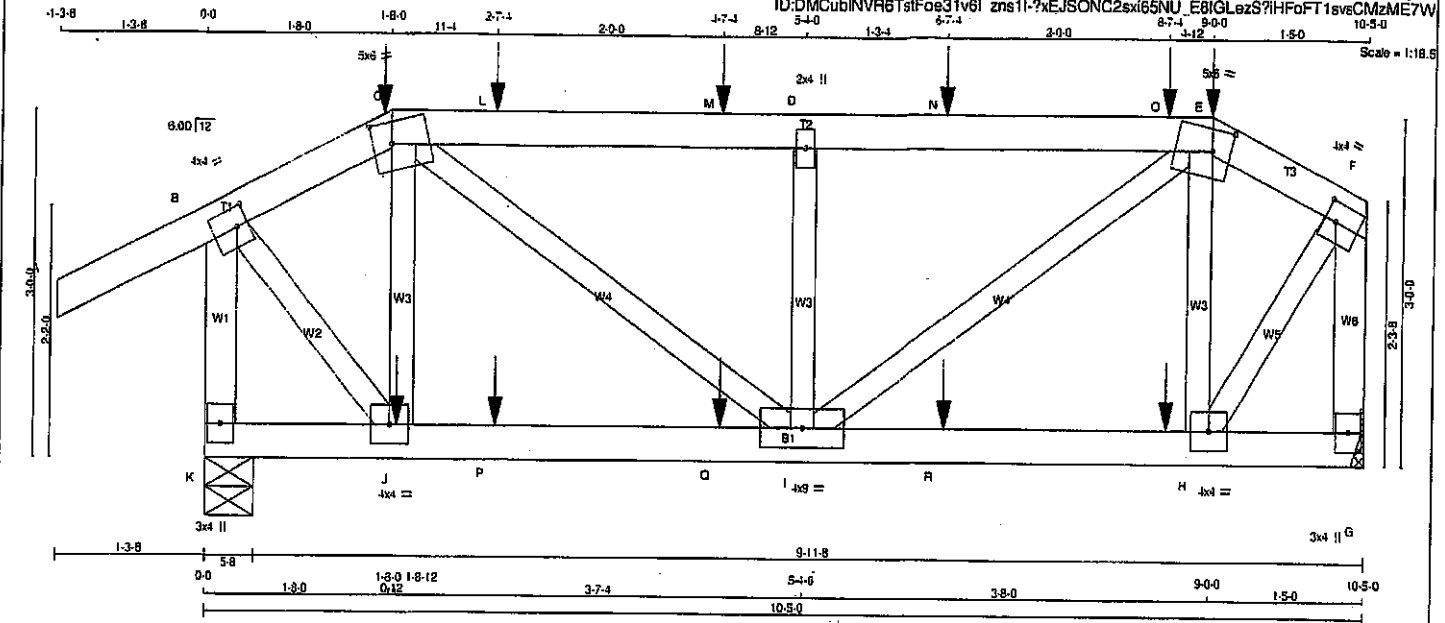

TOTAL WEIGHT = 46 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2		
C - E	2x4	DRY	No.2		
E - F	2x4	DRY	No.2		
F - G	2x4	DRY	No.2		
G - H	2x4	DRY	No.2		
H - I	2x4	DRY	No.2		
I - J	2x4	DRY	No.2		
J - K	2x4	DRY	No.2		

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	4.0	2.00	1.25
C	TTWW-m	MT20	5.0	6.0	2.25	2.00
D	TMVW-w	MT20	2.0	4.0		
E	TTWW-m	MT20	5.0	6.0	2.25	2.00
F	TMVW-t	MT20	4.0	4.0	2.00	1.25
G	BMV1-p	MT20	3.0	4.0		
H	BMVW-t	MT20	4.0	4.0		
I	BMVW-w	MT20	4.0	4.0		
J	BMVW-t	MT20	4.0	4.0		
K	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UP
K	818	0	818	0
G	679	0	679	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	576	393	0	0	0	183	0
G	480	317	0	0	0	182	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MEMB.	MAX. FACTORED	FACTORED	MAX. FACTORED
		(LBS)	(LBS)	(LBS)			(LBS)	(LBS)	(LBS)
FR-TO					FR-TO				
A-B	0 28	-91.8	-91.8	0.13 (1)	J-C	-307	0	0.08 (1)	
B-C	-427	0	-91.8	-91.8	0.13 (1)	C-I	0 438	0.11 (1)	
C-L	-702	0	-91.8	-91.8	0.26 (1)	I-D	-472	0	0.09 (1)
L-M	-702	0	-91.8	-91.8	0.26 (1)	M-E	0 469	0.12 (1)	
M-D	-702	0	-91.8	-91.8	0.26 (1)	E-H	-373	0	0.07 (1)
D-N	-702	0	-91.8	-91.8	0.26 (1)	N-J	0 523	0.13 (1)	
N-O	-702	0	-91.8	-91.8	0.26 (1)	H-F	0 556	0.14 (1)	
O-E	-702	0	-91.8	-91.8	0.26 (1)				
E-F	-379	0	-91.8	-91.8	0.04 (1)				
K-B	-812	0	0.0	0.0	0.10 (1)				
G-F	-677	0	0.0	0.0	0.09 (1)				

JT	LOC.	LOC.	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
JT	1-8-0	-53	-53	---	BACK	VERT	TOTAL	---	C1
E	9-0-0	-21	-21	---	FRONT	VERT	TOTAL	---	C1
H	8-7-4	-4	-4	---	BACK	VERT	TOTAL	---	C1
J	1-9-12	-4	-4	---	BACK	VERT	TOTAL	---	C1
L	2-7-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
M	4-7-4	-25	-25	---	BACK	VERT	TOTAL	---	C1
N	6-7-4	-25	-25	---	BACK	VERT	TOTAL	---	C1
O	8-7-4	-53	-53	---	BACK	VERT	TOTAL	---	C1
P	2-7-4	-4	-4	---	BACK	VERT	TOTAL	---	C1
Q	4-7-4	-4	-4	---	BACK	VERT	TOTAL	---	C1
R	6-7-4	-4	-4	---	BACK	VERT	TOTAL	---	C1

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LOC.	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
JT	1-8-0	-53	-53	---	BACK	VERT	TOTAL	---	C1
E	9-0-0	-21	-21	---	FRONT	VERT	TOTAL	---	C1
H	8-7-4	-4	-4	---	BACK	VERT	TOTAL	---	C1
J	1-9-12	-4	-4	---	BACK	VERT	TOTAL	---	C1
L	2-7-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
M	4-7-4	-25	-25	---	BACK	VERT	TOTAL	---	C1
N	6-7-4	-25	-25	---	BACK	VERT	TOTAL	---	C1
O	8-7-4	-53	-53	---	BACK	VERT	TOTAL	---	C1
P	2-7-4	-4	-4	---	BACK	VERT	TOTAL	---	C1
Q	4-7-4	-4	-4	---	BACK	VERT	TOTAL	---	C1
R	6-7-4	-4	-4	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 085-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

- 55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.26/1.00 (D-E:1) , BC=0.09/1.00 (I-J:1) ,
WB=0.14/1.00 (F-H:1) , SSI=0.21/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 798 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.77 (F) (INPUT = 0.90)
JSI METAL = 0.22 (F) (INPUT = 1.00)

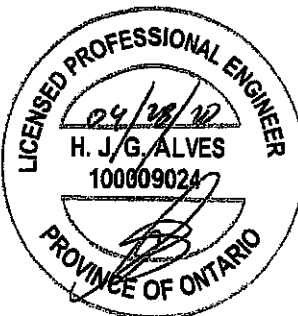

Structural component only
DWG# T-2007674

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	T54S	1	2	GREEN PARK HOMES	

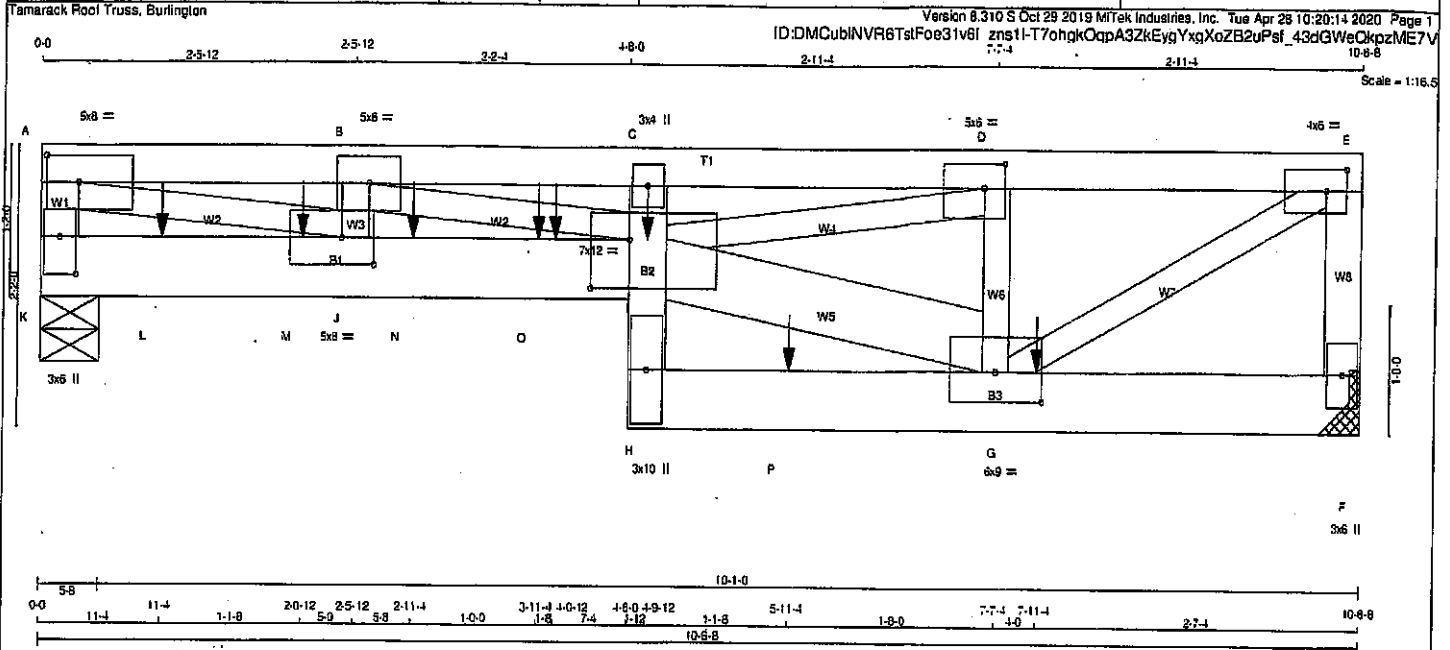

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
K - A	2x4 DRY	No.2	SPF		
A - E	2x4 DRY	No.2	SPF		
F - E	2x4 DRY	No.2	SPF		
K - I	2x6 DRY	No.2	SPF		
H - C	2x4 DRY	No.2	SPF		
H - F	2x6 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
EXCEPT					
I - G	2x6 DRY	No.2	SPF		

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122'X3") SPIRAL NAILS		
K-A	12	TOP
A-E	12	TOP
E-F	12	TOP
BOTTOM CHORDS : (0.122'X3") SPIRAL NAILS		
K-I	12	SIDE (81.0)
H-F	12	SIDE (183.1)
C-H	5	SIDE (89.1)
WEBS : (0.122'X3") SPIRAL NAILS		
2x3	8	
2x6	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
K	2604	0	2604	0	0	5-8	5-8
F	2255	0	2255	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 4-0.

UNFACTORED REACTIONS							
	1ST CASE	2ND CASE	3RD CASE	4TH CASE	5TH CASE	6TH CASE	7TH CASE
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	1841	1212	0	0	0	828	0
F	1592	1061	0	0	0	531	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.36 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING											
TOTAL LOAD CASES: (4)											
CHORDS						WEBS					
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	LC1 (FLP)	MAX CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)			
FR-TO		FROM	TO			FR-TO					
K-A	-2274	0	0.0	0.0	0.13 (1)	7.42	I-G	0	2888	0.19 (1)	
A-B	-6694	0	-91.8	-91.8	0.22 (1)	3.63	I-D	0	5926	0.73 (1)	
B-C	-10298	0	-91.8	-91.8	0.66 (1)	2.38	G-D	-2146	0	0.17 (1)	
C-D	-9247	0	-91.8	-91.8	0.61 (1)	2.62	G-E	0	4043	0.56 (1)	
D-E	-3416	0	-91.8	-91.8	0.16 (1)	4.91	J-B	-1577	0	0.12 (1)	
F-E	-2242	0	0.0	0.0	0.13 (1)	7.46	A-J	0	7027	0.87 (1)	
							B-I	0	3806	0.47 (1)	
K-L	0	0	-18.5	-18.5	0.21 (1)	10.00					
L-M	0	0	-18.5	-18.5	0.21 (1)	10.00					
M-J	0	0	-18.5	-18.5	0.21 (1)	10.00					
J-N	0	6894	-18.5	-18.5	0.79 (1)	10.00					
N-O	0	6894	-18.5	-18.5	0.79 (1)	10.00					
O-I	0	6894	-18.5	-18.5	0.79 (1)	10.00					
H-I	0	354	0.0	0.0	0.65 (1)	10.00					
I-C	0	128	0.0	0.0	0.63 (1)	10.00					
H-P	0	832	-18.5	-18.5	0.20 (1)	10.00					
P-G	0	832	-18.5	-18.5	0.20 (1)	10.00					
G-F	0	0	-18.5	-18.5	0.01 (4)	10.00					

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE
G	7-11-4	-881	-651	---	BACK	VERT	TOTAL
I	4-9-12	-577	-577	---	FRONT	VERT	TOTAL
L	11-4	-72	-72	---	BACK	VERT	TOTAL
M	2-0-12	-352	-352	---	FRONT	VERT	TOTAL
N	2-11-4	-142	-142	---	BACK	VERT	TOTAL
O	3-11-4	-983	-983	---	BACK	VERT	TOTAL
P	4-0-12	-354	-354	---	FRONT	VERT	TOTAL
P	5-11-4	-556	-556	---	BACK	VERT	TOTAL

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")

CALCULATED VERT. DEFL.(LL) = L/ 862 (0.15")

ALLOWABLE DEFL.(TL) = L/360 (0.35")

CALCULATED VERT. DEFL.(TL) = L/ 469 (0.27")

CSI: TC=0.66/1.00 (B-C:1), BC=0.79/1.00 (I-J:1), WB=0.87/1.00 (A-J:1), SSI=0.45/1.00 (C-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE GRIP(DRY)	SHEAR	SECTION	(PSI)	(PLF)	(PLF)
MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.88 (E) (INPUT = 0.90)

JSI METAL = 0.73 (D) (INPUT = 1.00)



Structural component only
DWG# T-2007675 1/2

JOB NAME 408224	TRUSS NAME T54S	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:20:14 2020 Page 2
ID:DMCubINVR6TstFog31v6l zns1l-T7ehakQqpA3ZKEvgYxqXoZB2uPef 43dGWbQkqzME7V

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-I	MT20	5.0	8.0	2.50	3.00
B	TMVW-I	MT20	5.0	6.0		
C	TMV+p	MT20	3.0	4.0		
D	TMVW-I	MT20	5.0	6.0	2.25	2.00
E	TMVW-I	MT20	4.0	6.0	2.00	2.00
F	BMV1+p	MT20	3.0	6.0		
G	BMVWVW-I	MT20	6.0	8.0	2.75	4.50
H	BMV+p	MT20	3.0	10.0		
I	BMVWVW-I	MT20	7.0	12.0	4.50	3.75
J	BMVW-I	MT20	5.0	8.0	2.50	3.00
K	BMV1+p	MT20	3.0	6.0	3.50	1.50



Structural component only
DWG# T-2007675 *HL*

JOB NAME 408222	TRUSS NAME V1	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:14 2020 Page 1
ID:DMCubINVR6TsfFoe31v6I zns11-0hm5FSlyQNJdta79MsYvGLOsMVq3LML6VkvQG0zMFIV 21-0-7

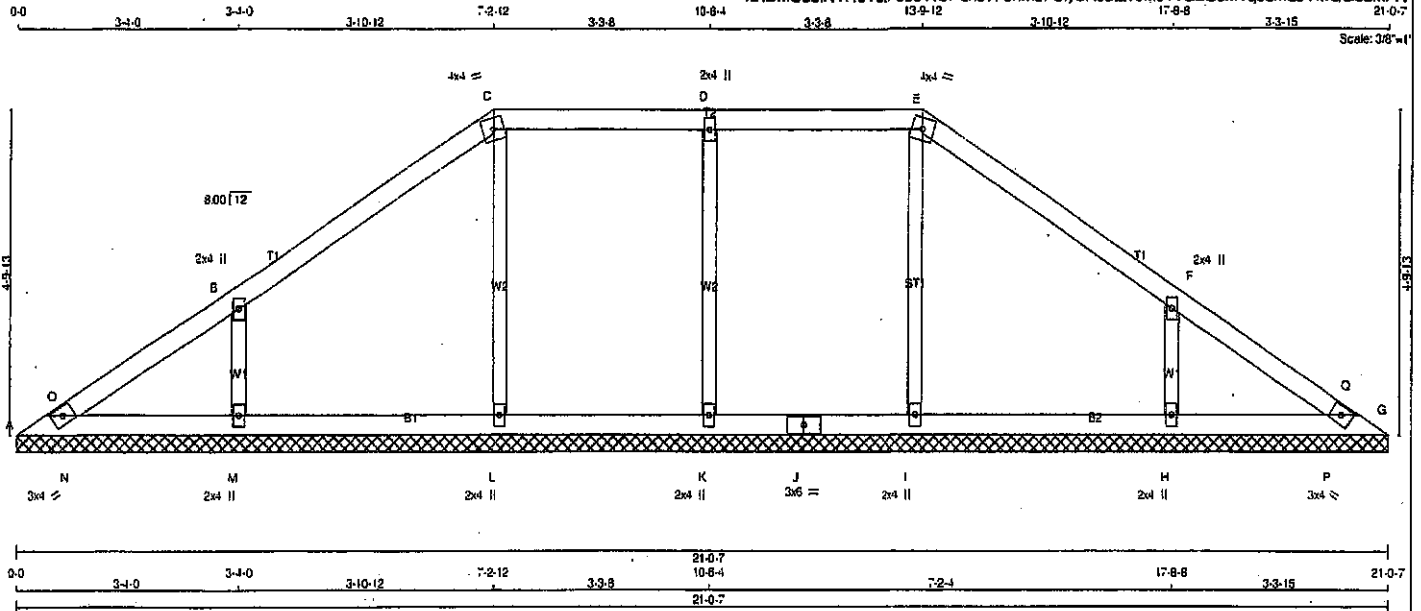

TOTAL WEIGHT = 63 lb (M)

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
A - C	2x4	DRY No.2
C - E	2x4	DRY No.2
E - G	2x4	DRY No.2
A - J	2x4	DRY No.2
J - G	2x4	DRY No.2

ALL WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

DESCR.

SPF
SPF
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
A	128	0	128	0	21-0-7 (11-11)2Q-7	IN-SX
G	128	0	128	0	21-0-7 (11-11)2Q-7	IN-SX
I	330	0	330	0	21-0-7 (11-11)2Q-7	IN-SX
L	330	0	330	0	21-0-7 (11-11)2Q-7	IN-SX
K	433	0	433	0	21-0-7 (11-11)2Q-7	IN-SX
H	485	0	485	0	21-0-7 (11-11)2Q-7	IN-SX
M	485	0	485	0	21-0-7 (11-11)2Q-7	IN-SX

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	COMBINED	1ST CASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
		SNOW	LIVE	PERM. LIVE	WIND			
A	90	61	0	0	0	29	0	0
G	90	61	0	0	0	29	0	0
I	235	143	0	0	0	93	0	0
L	235	143	0	0	0	93	0	0
K	304	212	0	0	0	92	0	0
H	342	228	0	0	0	114	0	0
M	342	228	0	0	0	114	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, G, I, L, K, H, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO		FR-TO			
A-O	-23 2	-91.8 -91.8	0.04 (1)	0.25	J-E	-266 0	0.09 (1)
O-B	0 33	-91.8 -91.8	0.21 (1)	10.00	L-C	-266 0	0.09 (1)
B-C	-8 8	-91.8 -91.8	0.20 (1)	10.00	K-D	-377 0	0.13 (1)
C-D	0 17	-91.8 -91.8	0.17 (1)	10.00	H-F	-393 0	0.06 (1)
D-E	0 17	-91.8 -91.8	0.17 (1)	10.00	M-B	-393 0	0.06 (1)
E-F	-8 8	-91.8 -91.8	0.20 (1)	10.00	N-O	-39 5	0.00 (1)
F-G	0 33	-91.8 -91.8	0.21 (1)	10.00	P-Q	-39 5	0.00 (1)
G-H	-23 2	-91.8 -91.8	0.04 (1)	6.25			
A-N	-9 0	-18.5 -18.5	0.05 (1)	10.00			
N-M	-7 7	-18.5 -18.5	0.06 (4)	10.00			
M-L	-11 0	-18.5 -18.5	0.06 (4)	6.25			
L-K	-17 0	-18.5 -18.5	0.05 (4)	6.25			
K-J	-17 0	-18.5 -18.5	0.05 (4)	6.25			
J-I	-17 0	-18.5 -18.5	0.05 (4)	6.25			
I-H	-11 0	-18.5 -18.5	0.06 (4)	6.25			
H-P	-7 7	-18.5 -18.5	0.06 (4)	10.00			
P-G	-9 0	-18.5 -18.5	0.05 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 085-08, CSA 085-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS: TC=0.21 (1.00 (B-O:1), BC=0.09/1.00 (L-M:4), WB=0.13/1.00 (D-K:1), SS=0.15/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1667 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.61 (C) (INPUT = 0.99)
JSI METAL=0.20 (F) (INPUT = 1.00)

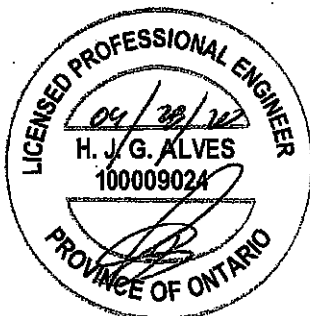


Structural component only
DWG# T-2007616

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	V2	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:15 2020 Page 1

ID:DMCubINVR6TstFoe31v6t zns11-UIKITnJa hRUkaLwZ38oYw1qu824cpFkQeozTzMFIL

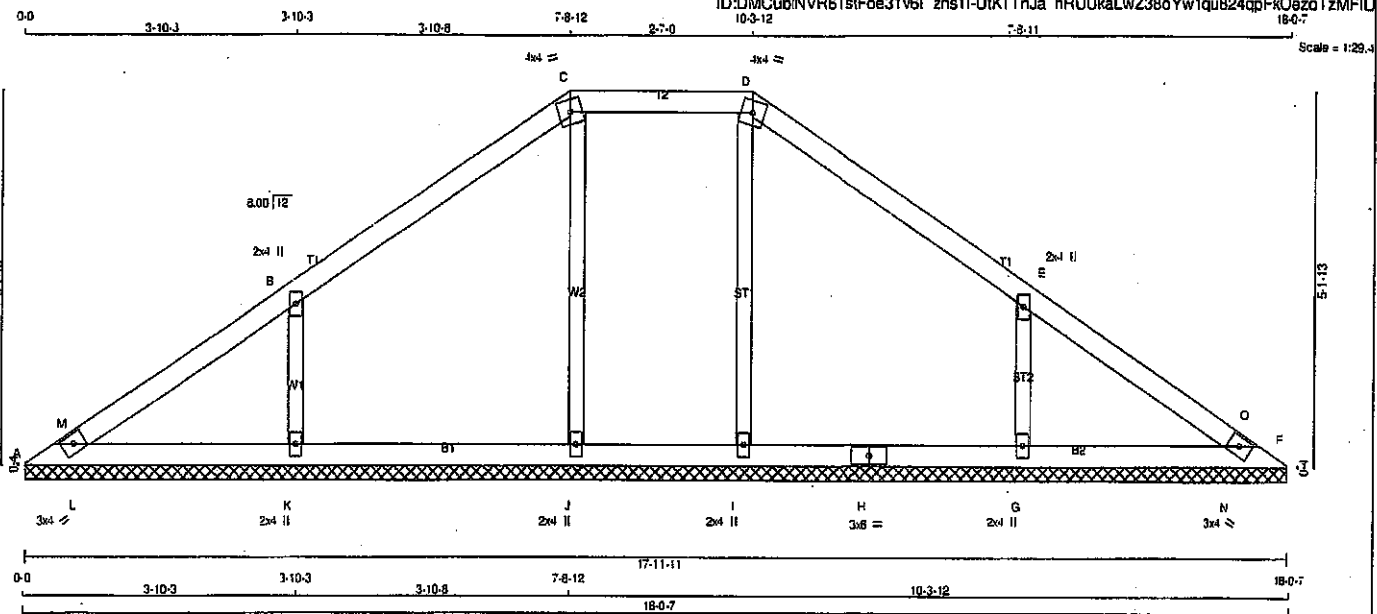

TOTAL WEIGHT = 54 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
A - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TBM1-h	MT20	3.0	4.0
B	TMW-w	MT20	2.0	4.0
C	TTW-m	MT20	4.0	4.0
D	TTW-m	MT20	4.0	4.0
E	TMW-w	MT20	2.0	4.0
F	TBM1-h	MT20	3.0	4.0
G, I, J, K				
G	BMW1-w	MT20	2.0	4.0
H	SS-1	MT20	3.0	6.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	DOWN	HORZ	UP/LIFT	IN-SX	IN-SX	BRG
A	136	0	136	0	0	0	17-11-11	11-17-12-11	
F	136	0	136	0	0	0	17-11-11	11-17-12-11	
I	344	0	344	0	0	0	17-11-11	11-17-12-11	
G	513	0	513	0	0	0	17-11-11	11-17-12-11	
J	342	0	342	0	0	0	17-11-11	11-17-12-11	
K	513	0	513	0	0	0	17-11-11	11-17-12-11	

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	55	65 0	0 0	0 0	0 0	30 0	0 0
F	55	65 0	0 0	0 0	0 0	30 0	0 0
I	244	155 0	0 0	0 0	0 0	69 0	0 0
G	362	240 0	0 0	0 0	0 0	122 0	0 0
J	242	154 0	0 0	0 0	0 0	68 0	0 0
K	362	240 0	0 0	0 0	0 0	122 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, F, I, G, J, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. CSI (LBS)	MEMB.	FORCE (LBS)	MAX. CSI (LBS)	MAX. CSI (LBS)
FR-TO		FROM TO		FR-TO			
A-M	0 20	-91.8 -91.8 0.04 (1)	10.00	I-D	-292 0	0.11 (1)	
M-B	0 71	-91.8 -91.8 0.22 (1)	10.00	G-E	-408 0	0.07 (1)	
B-C	0 33	-91.8 -91.8 0.22 (1)	10.00	J-C	-291 0	0.11 (1)	
C-D	0 52	-91.8 -91.8 0.11 (1)	10.00	K-B	-408 0	0.07 (1)	
D-E	0 33	-91.8 -91.8 0.22 (1)	10.00	L-M	-71 4	0.00 (1)	
E-O	0 71	-91.8 -91.8 0.22 (1)	10.00	N-O	-89 5	0.00 (1)	
O-F	0 19	-91.8 -91.8 0.04 (1)	10.00				

A-L	-43 0	-18.5 -18.5 0.07 (1)	6.25
L-K	-30 0	-18.5 -18.5 0.07 (1)	6.25
K-J	-45 0	-18.5 -18.5 0.07 (4)	6.25
J-I	-52 0	-18.5 -18.5 0.04 (4)	6.25
I-H	-45 0	-18.5 -18.5 0.07 (4)	6.25
H-G	-45 0	-18.5 -18.5 0.07 (4)	6.25
G-N	-30 0	-18.5 -18.5 0.07 (1)	6.25
N-F	-43 0	-18.5 -18.5 0.07 (1)	6.25

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.22(1.00 (E-O:1), BC=0.07(1.00 (K-L:1), WB=0.11 1.00 (D-I:1), SSI=0.14(1.00 (D-E:1))

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	616 354 1667	788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.81 (C) (INPUT = 0.90)
JSI METAL= 0.21 (E) (INPUT = 1.00)

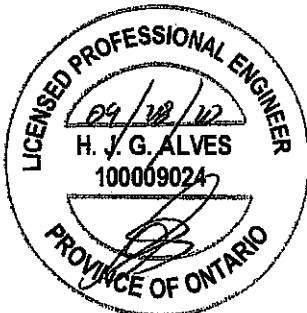

Structural component only
DWG# T-2007617

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	V3	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:00:16 2020 Page 1
ID:DMCubiNVR6TstFoe31v61_zns1l-y4trq7JCI_ZL6u9XTGaNLmTCiIVXpH4Cy2OWKvzMFIT

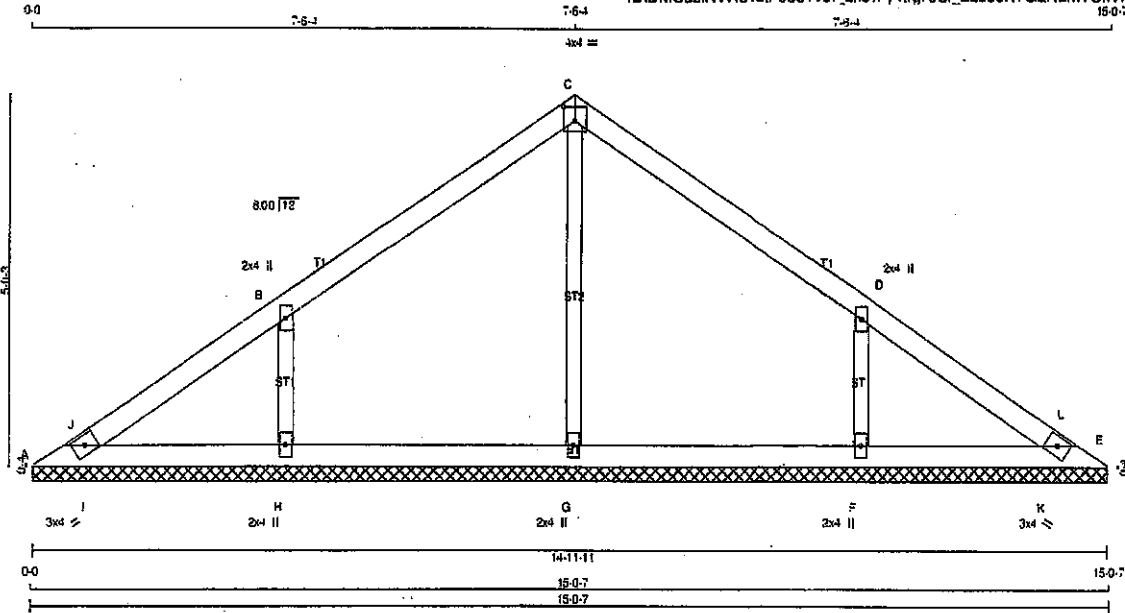

Scale = 1:28.8

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. SPF TOTAL WEIGHT = 43 lb

A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
A - E	2x4	DRY	No.2	SPF
ALL WEBS 2x3 DRY No.2 SPF				
DRY, SEASONED LUMBER.				

JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B	TMW+w	MT20	2.0	4.0		
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TMW+w	MT20	2.0	4.0		
E	TBM1-h	MT20	3.0	4.0		
F, G, H	BMW1+w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER.

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
A	134	0	134	0	14-11-11	14-11-11
E	134	0	134	0	14-11-11	14-11-11
G	381	0	381	0	14-11-11	14-11-11
H	501	0	501	0	14-11-11	14-11-11
F	501	0	501	0	14-11-11	14-11-11

UNFACTORED REACTIONS							
1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	95	65 0	0 0	0 0	0 0	30 0	0
E	95	65 0	0 0	0 0	0 0	30 0	0
G	272	182 0	0 0	0 0	0 0	110 0	0
H	353	237 0	0 0	0 0	0 0	116 0	0
F	353	237 0	0 0	0 0	0 0	116 0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, G, H, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1		MAX. CS1 (LC1) UNBRAC	MAX. LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC1)
		FROM	TO					
FR-TO								
A-J	-20 4	-91.8	-91.8	0.04 (1)	8.25	G-C	-318 0	0.11 (1)
J-B	0 36	-91.8	-91.8	0.22 (1)	10.00	H-B	-406 0	0.06 (1)
B-C	-5 12	-91.8	-91.8	0.21 (1)	10.00	F-D	-406 0	0.06 (1)
C-D	-5 12	-91.8	-91.8	0.21 (1)	10.00	I-J	-46 6	0.00 (1)
D-L	0 36	-91.8	-91.8	0.22 (1)	10.00	K-L	-46 6	0.00 (1)
L-E	-20 4	-91.8	-91.8	0.04 (1)	6.25			
A-I	-13 0	-18.5	-18.5	0.06 (1)	8.25			
I-H	-10 3	-18.5	-18.5	0.06 (4)	8.25			
H-G	-13 0	-18.5	-18.5	0.06 (4)	8.25			
G-F	-13 0	-18.5	-18.5	0.06 (4)	8.25			
F-K	-10 3	-18.5	-18.5	0.06 (4)	8.25			
K-E	-13 0	-18.5	-18.5	0.06 (1)	6.25			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS1: TC=0.22:1.00 (B-J:1), BC=0.09:1.00 (G-H:4), WB=0.11:1.00 (C-G:1), SS=0.15:1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1997 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.28 (D) (INPUT = 0.90)
JSI METAL = 0.21 (D) (INPUT = 1.00)

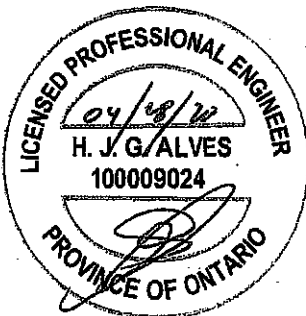


Structural component only
DWG# T-2007618

JOB NAME 408222	TRUSS NAME V4	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	-------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 11:37:42 2020 Page 1
ID:DMCubINVR6Tsf0a31v6l_zns1I-NKaqA2eMCGf4MYH_q82VAKhU92Pb0QNm3IZNsPzMD_1

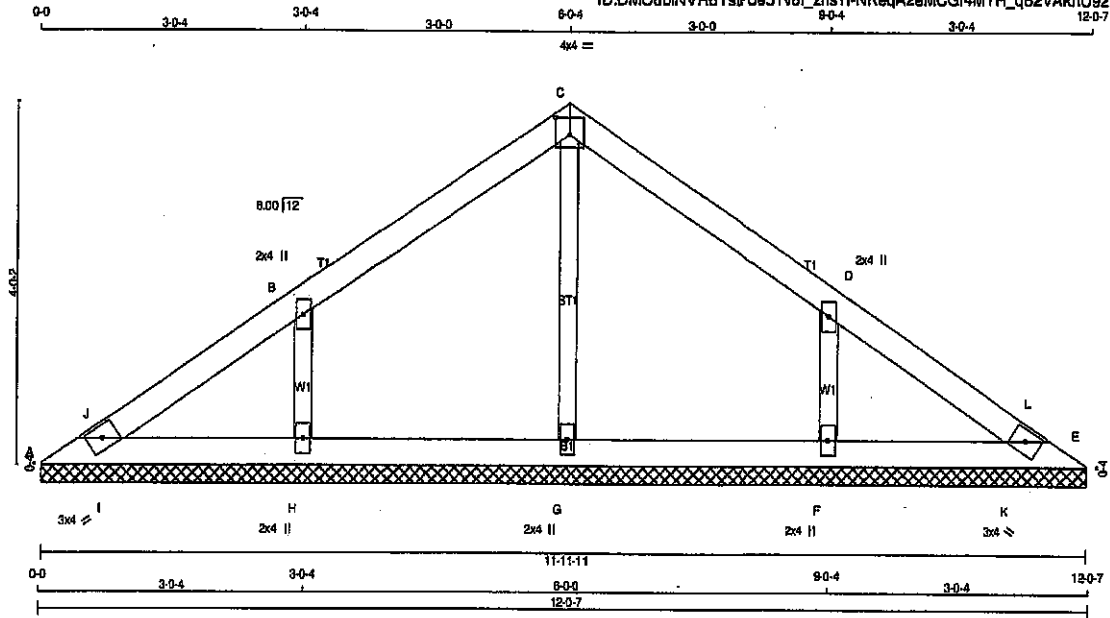

TOTAL WEIGHT = 34 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES											
CHORDS	SIZE	LUMBER	DESCR.	SPF	SPF	SPF	SPF				
A - C	2x4	DRY	No.2	SPF							
C - E	2x4	DRY	No.2	SPF							
A - E	2x4	DRY	No.2	SPF							
ALL WEBS	2x3	DRY	No.2	SPF							
DRY: SEASONED LUMBER.											

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
A - TBM1-h	MT20	3.0	4.0		
B - TMW-w	MT20	2.0	4.0		
C - TTW-p	MT20	4.0	4.0	2.25	2.00
D - TMW-w	MT20	2.0	4.0		
E - TBM1-h	MT20	3.0	4.0		
F, G, H					
F - BMW1-w	MT20	2.0	4.0		

UNFACTORED REACTIONS							
1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
JT COMBINED							
A	83	56/0	0/0	0/0	26/0	0/0	
E	83	56/0	0/0	0/0	26/0	0/0	
G	207	125/0	0/0	0/0	82/0	0/0	
F	281	188/0	0/0	0/0	93/0	0/0	
H	281	188/0	0/0	0/0	93/0	0/0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, G, F, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-J	-8/5	-91.8 -91.8	0.03 (1)	G-C	-248/0	0.08 (1)	
J-B	0/38	-91.8 -91.8	0.13 (1)	F-D	-314/0	0.05 (1)	
B-C	0/12	-91.8 -91.8	0.13 (1)	H-B	-314/0	0.05 (1)	
C-D	0/12	-91.8 -91.8	0.13 (1)	I-J	-47/4	0.00 (1)	
D-L	0/36	-91.8 -91.8	0.13 (1)	K-L	-47/4	0.00 (1)	
L-E	-8/5	-91.8 -91.8	0.03 (1)				
A-I	-13/0	-18.5 -18.5	0.05 (1)				
I-H	-10/0	-18.5 -18.5	0.05 (1)				
H-G	-20/0	-18.5 -18.5	0.04 (4)				
G-F	-20/0	-18.5 -18.5	0.04 (4)				
F-K	-10/0	-18.5 -18.5	0.05 (1)				
K-E	-13/0	-18.5 -18.5	0.05 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.6 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 096-09, CSA 098-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (B-J:1), BC=0.05/1.00 (A-I:1), WB=0.08/1.00 (C-G:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 786 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.22 (D) (INPUT = 0.90)
JSI METAL=0.16 (B) (INPUT = 1.00)

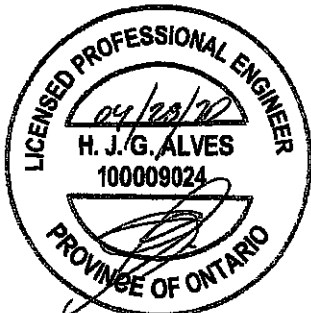


Structural component only
DWG# T-2007619

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	V5	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:00:17 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns11-QGREITKqWthCk2kk1_Sclz?N9ip5Y[B]YB74ILzMFIS

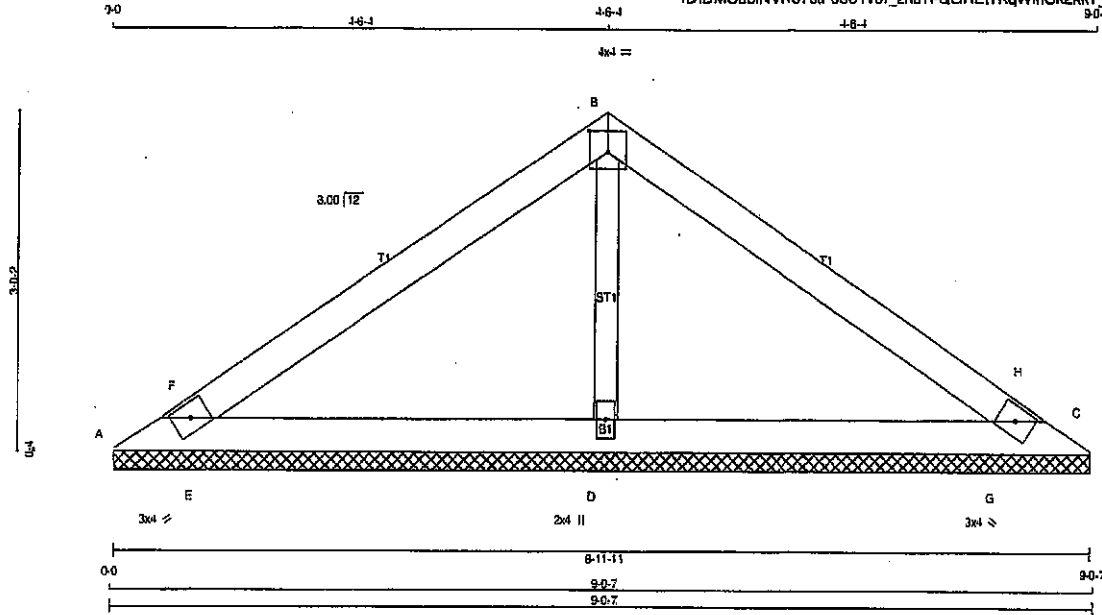

Scale = 1:19.0

TOTAL WEIGHT = 23 lb

LUMBER

N. L. G. A. RULES					
CHORDS		SIZE		LUMBER	DESCR.
A - B	2x4	DRY		No.2	SPF
B - C	2x4	DRY		No.2	SPF
A - C	2x4	DRY		No.2	SPF
ALL WEBS		2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.					

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B	TTW-p	MT20	4.0	4.0	2.25	2.00
C	TBM1-h	MT20	3.0	4.0		
D	BMW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REORD BRG
	VERT	HORZ	DOWN	HORZ
A	49	0	49	0
C	49	0	49	0
D	893	0	893	0

UNFACTORED REACTIONS

JT	1ST LCASE	MAX MIN COMPONENT REACTIONS	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
A	34	22.0	0.0	0.0	0.0	0.0	12.0	0.0
C	34	22.0	0.0	0.0	0.0	0.0	12.0	0.0
D	631	415.0	0.0	0.0	0.0	0.0	216.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-F	0 347	-91.8 -91.8 0.12 (1)	10.00	D-B	-698 0	0.12 (1)	
F-B	0 341	-91.8 -91.8 0.23 (1)	10.00	E-F	-225 0	0.00 (1)	
B-H	0 341	-91.8 -91.8 0.23 (1)	10.00	G-H	-225 0	0.00 (1)	
H-C	0 347	-91.8 -91.8 0.12 (1)	10.00				
A-E	-321 0	-18.5 -18.5 0.16 (1)	6.25				
E-D	-280 0	-18.5 -18.5 0.17 (1)	6.25				
D-G	-290 0	-18.5 -18.5 0.17 (1)	6.25				
G-C	-321 0	-18.5 -18.5 0.16 (1)	6.25				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.23(1.00 (B-F:1) , BC=0.17(1.00 (D-E:1) , WB=0.12(1.00 (B-D:1) , SS=0.12(1.00 (A-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.59 (B) INPUT = 0.60
JSI METAL= 0.20 (B) INPUT = 1.00

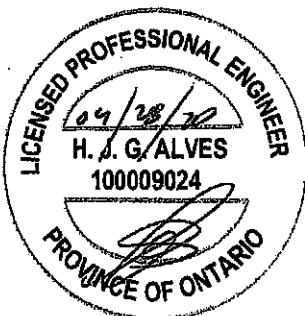


Structural component only
DWG# T-2007620

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408222	PB1	2	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 08:00:02 2020 Page 1
ID:DMCubINVR6TstFoe31v6I zns1I-MN1ZkL9Q2hoKOk4rKK5mpuqJfFXyLks?nrjzMFh

Scale = 1:16.4

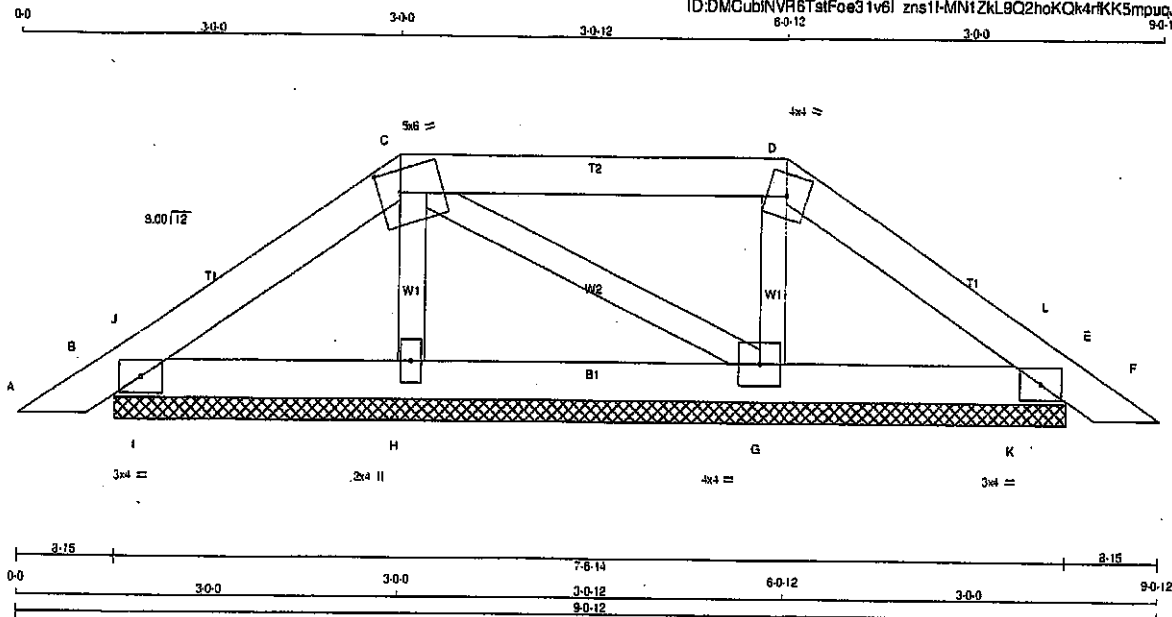

LUMBER	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES				
CHORDS	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
B - E	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE PLATES				
B TMB1-i	MT20	3.0	4.0	
C TTW-m	MT20	5.0	6.0	2.00
D TTW-m	MT20	4.0	4.0	
E TMB1-i	MT20	3.0	4.0	
G BMWW1-i	MT20	4.0	4.0	
H BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UP	IN-SX
B	221	0	0	7-6-14
E	209	0	0	7-6-14
H	248	0	0	7-6-14
G	280	0	0	7-6-14

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	SNOW
B	154
E	146
H	176
G	198

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	FACTORED	WEBS	MEMB.	MAX. FACTORED
		FORCE (LBS)	VERT. LOAD (LBS)			FORCE (LBS)
FR-TO				FR-TO		
A-B	0 15	-91.8	-91.8 0.03 (1)	H-C	-176 0	0.03 (1)
B-J	-63 0	-91.8	-91.8 0.01 (1)	C-G	-21 0	0.00 (1)
J-C	-75 0	-91.8	-91.8 0.05 (1)	G-D	-198 0	0.03 (1)
C-D	-30 0	-91.8	-91.8 0.15 (1)	I-J	-121 0	0.00 (1)
D-L	-54 0	-91.8	-91.8 0.05 (1)	K-L	-123 0	0.00 (1)
L-E	-41 0	-91.8	-91.8 0.01 (1)			
E-F	0 15	-91.8	-91.8 0.03 (1)			
B-I	0 80	-18.5	-18.5 0.06 (1)			
I-H	0 60	-18.5	-18.5 0.06 (1)			
H-G	0 48	-18.5	-18.5 0.03 (1)			
G-K	0 43	-18.5	-18.5 0.06 (1)			
K-E	0 43	-18.5	-18.5 0.06 (1)			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS: TC=0.15/1.00 (C-D:1), BC=0.08/1.00 (B-I:1), WB=0.03/1.00 (D-G:1), SS=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

MAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1967 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.18 (B) INPUT = 0.90
JSI METAL= 0.04 (B) INPUT = 1.00



Structural component only
DWG# T-2007600

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	PB2	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 M&T Tek Industries, Inc. Tue Apr 28 09:00:03 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-qabxxh92p?wB2u12D2sKJ0Q?w31_GPEUzWkKN9zMF1q

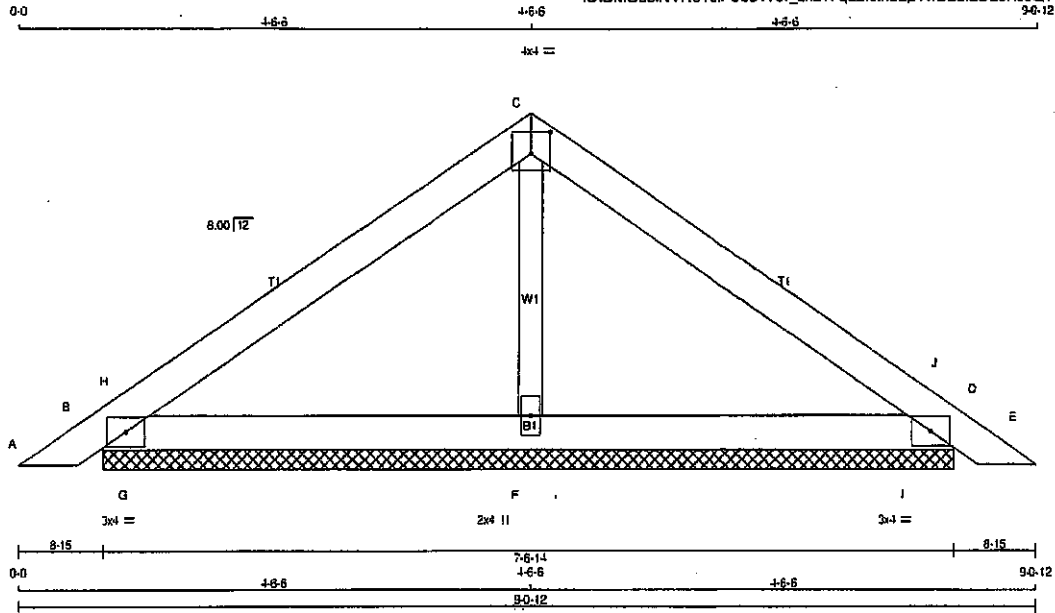

TOTAL WEIGHT = 2 X 23 = 46 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES				BEARINGS				SPECIFIED LOADS:			
CHORDS	SIZE	LUMBER	DESCR.	FACTORED	MAXIMUM FACTORED	INPUT	RECORD	TOP CH. LL	DL	PSF	
A - C	2x4	DRY	No.2	GROSS REACTION	GROSS REACTION	BRG	BRG	OT CH. LL	DL	PSF	
B - E	2x4	DRY	No.2	VERT	DOWN	HORZ	UPLIFT	OT CH. LL	DL	PSF	
C - D	2x4	DRY	No.2	318	0	318	0	OT CH. LL	DL	PSF	
ALL WEBS	2x3	DRY	No.2	318	0	318	0	OT CH. LL	DL	PSF	
DRY: SEASONED LUMBER.				320	0	320	0	OT CH. LL	DL	PSF	

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	3.0	4.0	
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TMB1-I	MT20	3.0	4.0	
F	BMW1-w	MT20	2.0	4.0	

UNFACTORED REACTIONS							
JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
B	223	159 0	0 0	0 0	0 0	63 0	0 0
D	223	159 0	0 0	0 0	0 0	63 0	0 0
F	229	137 0	0 0	0 0	0 0	92 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	
FR-TO				FR-TO			
A-B	0 15	-91.8 -91.8 0.03 (1)	10.00	F-C	-148 0	0.03 (1)	
B-H	-31 0	-91.8 -91.8 0.07 (1)	6.25	G-H	-349 0	0.00 (1)	
H-C	-135 0	-91.8 -91.8 0.16 (1)	6.25	I-J	-349 0	0.00 (1)	
C-J	-135 0	-91.8 -91.8 0.16 (1)	6.25				
J-D	-31 0	-91.8 -91.8 0.07 (1)	6.25				
D-E	0 15	-91.8 -91.8 0.03 (1)	10.00				
B-G	0 105	-18.5 -18.5 0.15 (1)	10.00				
G-F	0 105	-18.5 -18.5 0.15 (1)	10.00				
F-I	0 105	-18.5 -18.5 0.15 (1)	10.00				
I-D	0 105	-18.5 -18.5 0.15 (1)	10.00				

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.16 (1.00 (C-J:1), BC=0.15 (1.00 (F-I:1), WB=0.03 (1.00 (C-F:1), SS=0.26 (1.00 (D-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.25 (D) INPUT = 0.90
JSI METAL= 0.07 (D) INPUT = 1.00




Structural component only
DWG# T-2007601

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	PB20	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 3.310 5 Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:03:58 2020 Page 1
ID:DMCubINVR6TstFoa31v6l zns11-6 lzPKYM7hrKX8JFY7B9Jg2AAFEry9gNMkIPVzMEMr

Scale = 1:15.6

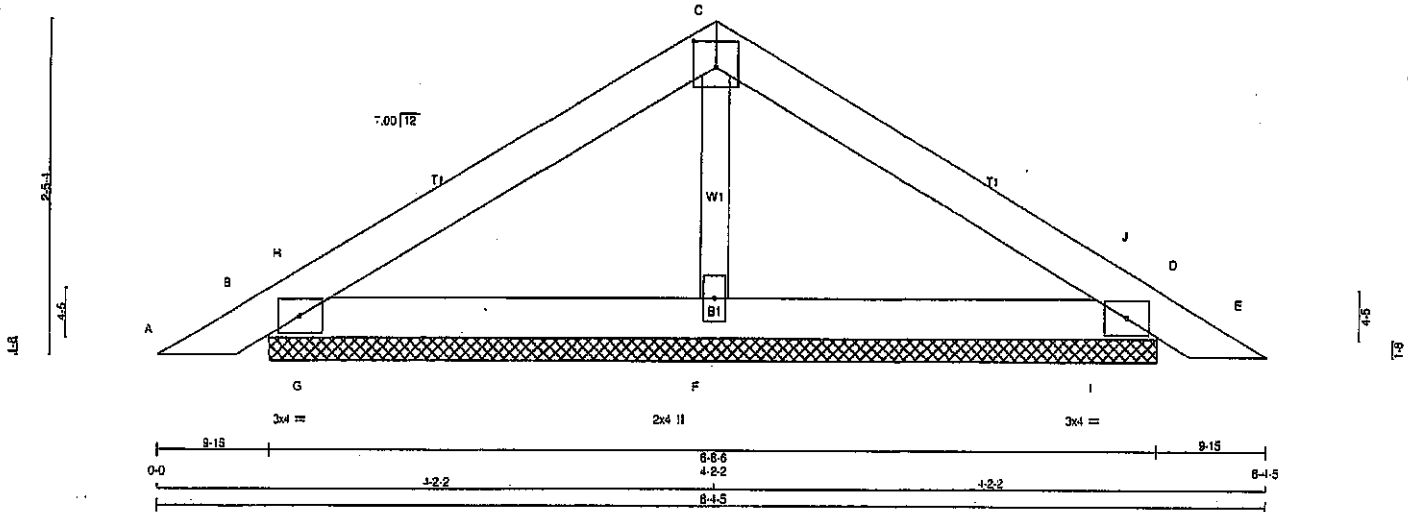

TOTAL WEIGHT = 4 X 20 = 80 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
B - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TMB1-I	MT20	3.0	4.0	
F	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING DESIGNER							
<u>BEARINGS</u>							
	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
B	281	0	281	0	0	6-8-6	6-8-6
D	281	0	281	0	0	6-8-6	6-8-6
F	314	0	314	0	0	6-8-6	6-8-6

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	197	141 0	0 0	0 0	0 0	55 0	0
D	197	141 0	0 0	0 0	0 0	55 0	0
F	224	137 0	0 0	0 0	0 0	87 0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 16	-91.8	-91.8 0.04 (1)	10.00	F-C	-159 0	0.02 (1)
B-H	-44 0	-91.8	-91.8 0.05 (1)	6.25	G-H	-250 0	0.00 (1)
H-C	-99 0	-91.8	-91.8 0.12 (1)	6.25	I-J	-250 0	0.00 (1)
C-J	-99 0	-91.8	-91.8 0.12 (1)	6.25			
J-D	-44 0	-91.8	-91.8 0.05 (1)	6.25			
D-E	0 16	-91.8	-91.8 0.04 (1)	10.00			
B-G	0 81	-18.5	-18.5 0.12 (1)	10.00			
G-F	0 81	-18.5	-18.5 0.12 (1)	10.00			
F-I	0 81	-18.5	-18.5 0.12 (1)	10.00			
I-D	0 81	-18.5	-18.5 0.12 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (C-H:1), EC=0.12/1.00 (B-G:1), WB=0.02/1.00 (C-F:1), SS=0.18/1.00 (D-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1667 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (D) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)





Structural component only
DWG# T-2007627

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	PB21	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 26 2019 MITek Industries, Inc. Tue Apr 28 10:03:57 2020 Page 1

ID:DMCubINVR6TslFoe31v6l zns1l-aAGLcfZ u zB05lvpFeQIXDDeZbFaPRpb0UDxxzMEMm

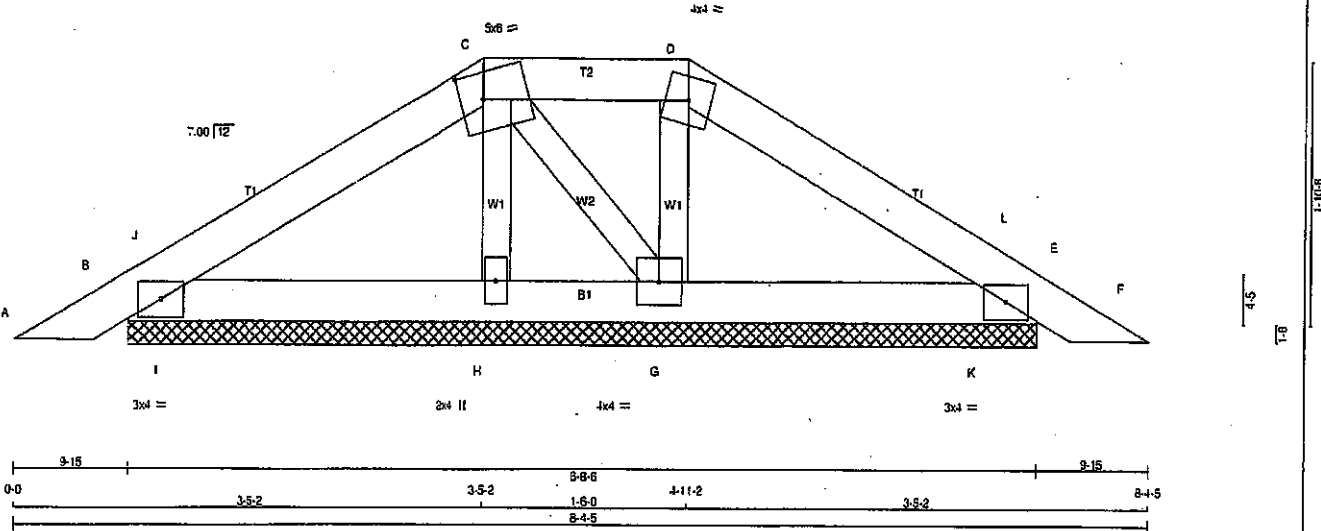

TOTAL WEIGHT = 22 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
B - E	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0		
C	TTW-m	MT20	5.0	6.0	2.25	2.00
D	TTW-m	MT20	4.0	4.0		
E	TMB1-I	MT20	3.0	4.0		
G	BMW1-I	MT20	4.0	4.0		
H	BMW1-I	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	HORZ	GROSS REACTION	GROSS REACTION	DOWN	HORZ	UP/LIFT	IN-SX	IN-SX
B	241	0	241	0	0	0	0	6-8-6	6-8-6
E	228	0	228	0	0	0	0	6-8-6	6-8-6
H	170	0	170	0	0	0	0	6-8-6	6-8-6
G	238	0	238	0	0	0	0	6-8-6	6-8-6

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	189	121.0	0.0	0.0	0.0	0.0	48.0	0.0
E	160	114.0	0.0	0.0	0.0	0.0	46.0	0.0
H	122	74.0	0.0	0.0	0.0	0.0	48.0	0.0
G	168	111.0	0.0	0.0	0.0	0.0	57.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MAX. UNBRAC	MEMB.	FORCE (LBS)	MAX. FACTORED
		(PLF)	CSI (L)	LENGTH			MAX. FACTORED
FR-TO		FROM	TO		FR-TO		MAX. FACTORED
A-B	0 16	-91.8	-91.8 0.04 (1)	10.00	H-C	-107 0	0.02 (1)
B-J	-59 0	-91.8	-91.8 0.01 (1)	6.25	C-G	-36 0	0.01 (1)
J-C	-71 0	-91.8	-91.8 0.07 (1)	6.25	G-D	-147 0	0.02 (1)
C-D	-28 0	-91.8	-91.8 0.04 (1)	6.25	I-J	-139 0	0.00 (1)
D-L	-46 0	-91.8	-91.8 0.07 (1)	6.25	K-L	-141 0	0.00 (1)
L-E	-33 0	-91.8	-91.8 0.01 (1)	6.25			
E-F	0 16	-91.8	-91.8 0.04 (1)	10.00			
B-I	0 59	-18.5	-18.5 0.07 (1)	10.00			
I-H	0 59	-18.5	-18.5 0.07 (1)	10.00			
H-G	0 52	-18.5	-18.5 0.04 (1)	10.00			
G-K	0 38	-18.5	-18.5 0.07 (1)	10.00			
K-E	0 38	-18.5	-18.5 0.07 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. G.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.07(1.00 (D-L:1), SC=0.07(1.00 (B-I:1), WB=0.02(1.00 (D-G:1), GS=0.11(1.00 (E-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	818	354	1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.19 (B) INPUT = 0.90)
JSI METAL= 0.05 (D) INPUT = 1.00)

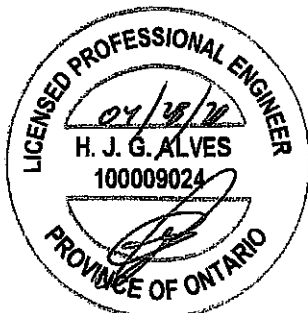


Structural component only
DWG# T-2007628

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	PB22	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Tue Apr 28 10:03:56 2020 Page 1
ID:DMCubINVR6TslFoe31v8t_zns11-2Mqjq?ac152eFK5Nz9fEkmO2zyGJsPzqqDmTNzMEMM

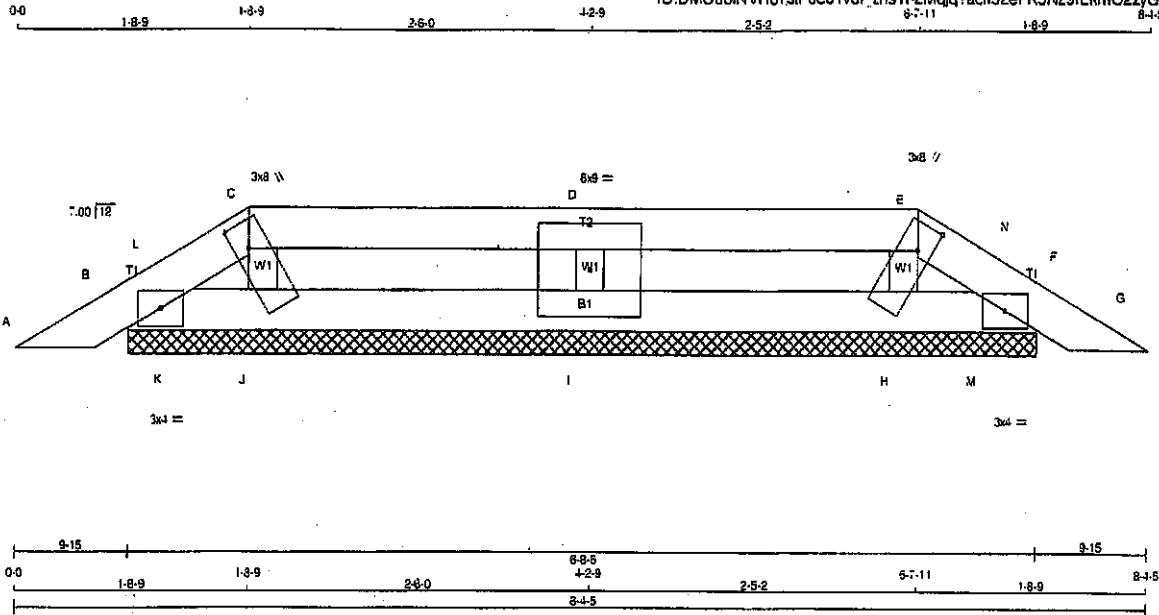

Scale = 1:15.2

LUMBER N. L. G. A. RULES LUMBER DESCR. TOTAL WEIGHT = 18 lb

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
E - G	2x4	DRY No.2	SPF
B - F	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0		
C, D, E, H, I, J						
C	TTBW1*-h	MT20	3.0	8.0	2.25	1.25
D	TMBMW1-I	MT20	8.0	9.0		
E	TTBW1*-h	MT20	3.0	8.0	2.25	1.25
F	TMB1-I	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING DESIGNER									
BEARINGS									
FACTORED			MAXIMUM FACTORED			INPUT		REQD	
GROSS REACTION			GROSS REACTION			BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX		IN-SX	
B	151	0	151	0	0	6-8-6		6-8-6	
F	152	0	152	0	0	6-8-6		6-8-6	
J	125	0	125	0	0	6-8-6		6-8-6	
H	120	0	120	0	0	6-8-6		6-8-6	
I	330	0	330	0	0	6-8-6		6-8-6	

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	105	83	0	0	0	21	0
F	105	83	0	0	0	22	0
J	90	49	0	0	0	41	0
H	86	47	0	0	0	39	0
I	232	158	0	0	0	74	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F, J, H, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 16	-91.8 -91.8	0.04 (1)	10.00	J-C	-95 0	0.01 (1)
B-L	-53 0	-91.8 -91.8	0.04 (1)	6.25	H-E	-92 0	0.01 (1)
L-C	-22 0	-91.8 -91.8	0.01 (1)	6.25	I-D	-282 0	0.04 (1)
C-D	0 3	-91.8 -91.8	0.09 (1)	10.00	K-L	-1 12	0.00 (1)
D-E	0 3	-91.8 -91.8	0.09 (1)	10.00	M-N	0 13	0.00 (1)
E-N	-21 0	-91.8 -91.8	0.01 (1)	6.25			
N-F	-52 0	-91.8 -91.8	0.04 (1)	6.25			
F-G	0 16	-91.8 -91.8	0.04 (1)	10.00			
B-K	0 14	-18.5 -18.5	0.01 (1)	10.00			
K-J	0 14	-18.5 -18.5	0.02 (4)	10.00			
J-I	-3 0	-18.5 -18.5	0.02 (4)	10.00			
I-H	-3 0	-18.5 -18.5	0.02 (4)	10.00			
H-M	0 14	-18.5 -18.5	0.01 (4)	10.00			
M-F	0 14	-18.5 -18.5	0.01 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.09/1.00 (D-E:1), BC=0.02/1.00 (H-J:4).
WB=0.04/1.00 (D-E:1), SSI=0.11/1.00 (C-D:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1687 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.13 (C) (INPUT = 0.90)
JSI METAL= 0.04 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007629

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	P20	17	1	TRUSS DESC.		

Famarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:03:55 2020 Page 1
ID:DMCubINVR6TstFoe31v6l zns1l-en8bC XkMjNjUnocViqbyd68sgmus6Uhw8l76l2zMEMo

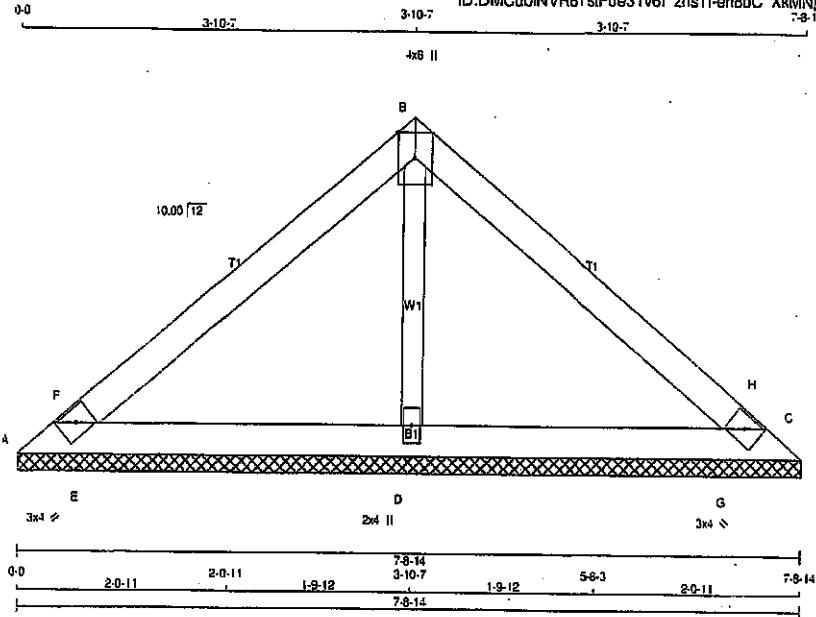

Scale = 1/20

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES				BEARINGS				SPECIFIED LOADS:			
CHORDS	SIZE	LUMBER	DESCR.	FACTORED	MAXIMUM FACTORED	INPUT	REQD	TOP CH.	LL	25.6	PSF
A - B	2x4	DRY	SPF	GROSS REACTION	GROSS REACTION	BRG	BRG	DL	6.0	PSF	
B - C	2x4	DRY	SPF	JT VERT	JT HORZ	DOWN	UP/LIFT	IN-SX	0.0	PSF	
A - C	2x4	DRY	SPF	A 60	0	60	0	7-8-14	7-8-14		
ALL WEBS	2x3	DRY	SPF	C 60	0	60	0	7-8-14	7-8-14		
DRY: SEASONED LUMBER.		No.2		D 733	0	733	0	7-8-14	7-8-14		
				UNFACTORED REACTIONS				SPACING = 24.0 IN. O.C.			
				1ST LCASE MAX. MIN. COMPONENT REACTIONS				THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015			
				JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
				A	43	28.0	0.0	0.0	0.0	14.0	0.0
				C	42	28.0	0.0	0.0	0.0	14.0	0.0
				D	518	339.0	0.0	0.0	0.0	179.0	0.0
				BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D				THIS DESIGN COMPLIES WITH:			
				BRACING				- PART 9 OF CBC 2010, CBC 2012, ABC 2019			
				TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.				- PART 9 OF CBC 2012 (2019 AMENDMENT)			
				MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.				- CSA D86-09, CSA D88-14			
				ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.				- TPIC 2011, TPIC 2014			
				LOADING				65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD			
				TOTAL LOAD CASES: (4)				CSI: TC=0.17 1.00 (B-F:1), BC=0.13 1.00 (D-E:1), WB=0.10 1.00 (B-D:1), SS=0.11 1.00 (G-G:1)			
				CHORDS				DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10			
				MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	
				FR-TO		FROM TO	LENGTH	FR-TO			
				A-F	0 227	-91.8 -91.8 0.09 (1)	10.00	D-B	-558 0	0.10 (1)	
				F-B	0 219	-91.8 -91.8 0.17 (1)	10.00	E-F	-199 0	0.00 (1)	
				B-H	0 219	-91.8 -91.8 0.17 (1)	10.00	G-H	-199 0	0.00 (1)	
				H-C	0 228	-91.8 -91.8 0.09 (1)	10.00				
				A-E	-207 0	-18.5 -18.5 0.13 (1)	6.25				
				E-D	-174 0	-18.5 -18.5 0.13 (1)	6.25				
				D-G	-174 0	-18.5 -18.5 0.13 (1)	6.25				
				G-C	-207 0	-18.5 -18.5 0.13 (1)	6.25				
				WEBS				COMPANION LIVE LOAD FACTOR = 1.00			
				MEMB.				TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.			
				MAX. FACTORED FORCE (LBS)				NAIL VALUES			
				MAX. FACTORED HORZ. LOAD (LBS)				PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PU)			
								MAX MIN MAX MIN MAX MIN			
								MT20 618 354 1687 788 1987 1658			
								PLATE PLACEMENT TOL. = 0.250 inches			
								PLATE ROTATION TOL. = 5.0 Deg.			
								JSI GRIP = 0.29 (D) INPUT = 0.90			
								JSI METAL = 0.12 (D) INPUT = 1.00			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TBM1-h	MT20	3.0	4.0	
B	TTW+p	MT20	4.0	6.0	Edge
C	TBM1-h	MT20	3.0	4.0	
D	BMW1+w	MT20	2.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.




Structural component only
DWG# T-2007626

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	PG20	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTK Industries, Inc. Tue Apr 28 10:03:59 2020 Page 1
ID:DMCubINVR6TstFos3tv8l zns1I-WYO61LaEQcDvFPvHxggunylaUNHa2Js63KzJ0pzMEMk

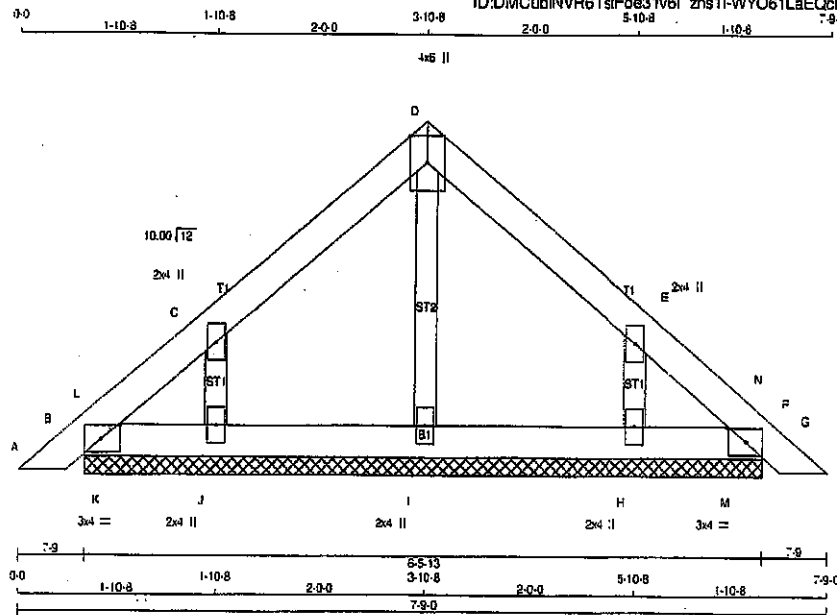

TOTAL WEIGHT = 2 X 22 = 45 lb

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES				
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
B - F	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
ALL GABLE WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				
GABLE STUDS SPACED AT	2-0-0	OC.		

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	1.50	2.00
C	TMW+w	MT20	2.0	4.0		
D	TTW+p	MT20	4.0	8.0	Edge	
E	TMW+w	MT20	2.0	4.0		
F	TMB1-I	MT20	3.0	4.0	1.50	2.00
H, I, J						
H	BMW1+w	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: 14)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0 14	-91.8 -91.8 0.02 (1)	10.00	I-D	-111 0	0.02 (1)	
B-L	-71 0	-91.8 -91.8 0.00 (1)	6.25	J-C	-185 0	0.03 (1)	
L-C	-30 0	-91.8 -91.8 0.05 (1)	6.25	H-E	-185 0	0.03 (1)	
C-D	-47 0	-91.8 -91.8 0.05 (1)	6.25	K-L	0 9	0.00 (1)	
D-E	-47 0	-91.8 -91.8 0.05 (1)	6.25	M-N	0 9	0.00 (1)	
E-N	-30 0	-91.8 -91.8 0.05 (1)	6.25				
N-F	-71 0	-91.8 -91.8 0.00 (1)	6.25				
F-G	0 14	-91.8 -91.8 0.02 (1)	10.00				
B-K	0 44	-18.5 -18.5 0.01 (1)	10.00				
K-J	0 44	-18.5 -18.5 0.01 (4)	10.00				
J-I	0 27	-18.5 -18.5 0.02 (4)	10.00				
I-H	0 27	-18.5 -18.5 0.02 (4)	10.00				
H-M	0 44	-18.5 -18.5 0.01 (4)	10.00				
M-F	0 44	-18.5 -18.5 0.01 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.05/1.00 (C-D:1), BC=0.02/1.00 (H-I:1), WB=0.03/1.00 (C-J:1), SSI=0.07/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788	1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP = 0.14 (E) (INPUT = 0.80)
JSI METAL = 0.10 (C) (INPUT = 1.00)

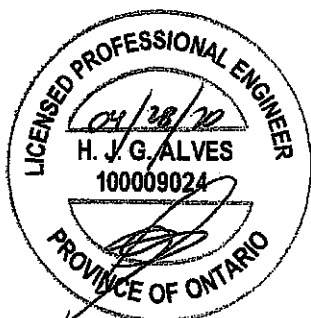

Structural component only
DWG# T-2007630

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	J1	21	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 9.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:01 2020 Page 1
ID:DMCubINVR6TsIFoe31v6I_zns11-uBTBW78oHNqUpbVf5dpsEblZQFMuoV7BWCFEIHZMFH

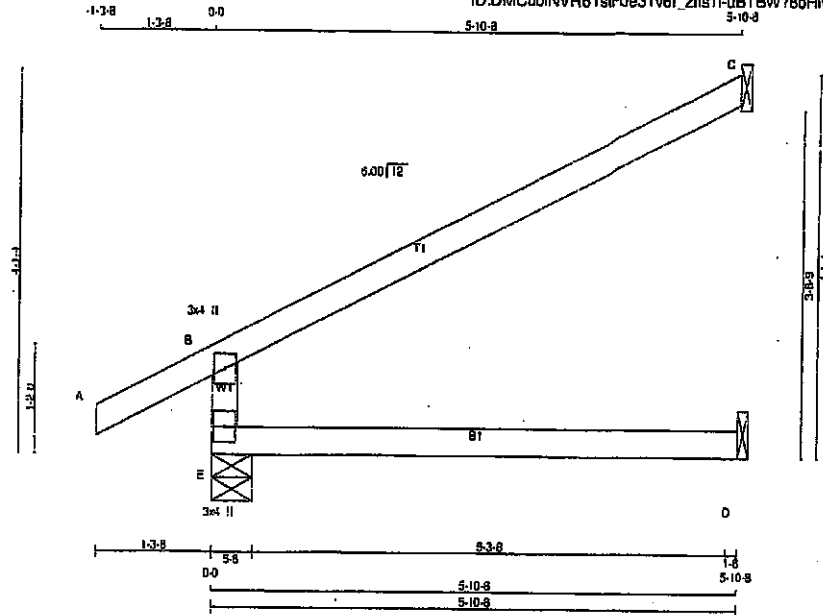

Scale = 1/32

LUMBER			
N.L.G.A. RULES	SIZE	LUMBER	DESCR.
E - B	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
E - D	2x4 DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMV+p	MT20	3.0	4.9	
E BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
E	525	0	525	0	0	5-8	5-8	5-8	5-8
C	202	0	202	0	0	1-8	1-8	1-8	1-8
D	45	0	50	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		MAX. MIN. COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	COMBINED	SNOW	LIVE	PERM. LIVE
E	369	257	0	0	0	0	0	111	0	0	0
C	139	113	0	0	0	0	0	26	0	0	0
D	38	0	0	0	0	0	0	36	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WESS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. CS (LC)	MEMB.	FORCE (LBS)	MAX. CS (LC)	MEMB.
FR-TO		FROM TO		FR-TO			
E-B	-461	0	0.0	0.0	0.13 (4)	7.81	
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00	
B-C	-30	0	-91.8	-91.8	0.54 (1)	6.25	
E-D	0	0	-18.5	-18.5	0.13 (4)	10.00	

TOTAL WEIGHT = 21 X 17 = 353 lb

DESIGN CRITERIA

SPECIFIED LOADS:		
TOP CH.	LL =	25.6 PSF
	DL =	6.0 PSF
BOT CH.	LL =	0.0 PSF
	DL =	7.4 PSF
TOTAL LOAD = 39.0 PSF		

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CS: TC=0.54 (1.00 (B-C:1), BC=0.13 (1.00 (D-E:4), WB=0.00 (1.00 (A-B:0), SS=0.24 (1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.19 (E) INPUT = 0.90
JSI METAL = 0.13 (B) INPUT = 1.00



Structural component only
DWG# T-2007598

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	J2S	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:00:01 2020 Page 1

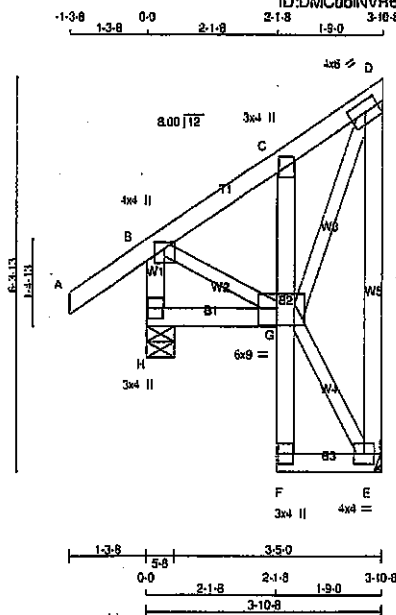

TOTAL WEIGHT = 4 X 31 = 125 lb

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES					
H - B	2x4	DRY	No.2	SPF	
A - D	2x4	DRY	No.2	SPF	
H - G	2x4	DRY	No.2	SPF	
F - C	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TMV+p	MT20	3.0	4.0		
D	TMVW-H	MT20	4.0	6.0	2.00	2.75
E	BMVW1-H	MT20	4.0	4.0		
F	BMV+p	MT20	3.0	4.0		
G	BVMWVW-H	MT20	6.0	9.0	3.25	3.50
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
H	332	0	332	0
E	208	0	208	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	232	168 0	0 0	0 0	0 0	68 0	0 0
E	145	95 0	0 0	0 0	0 0	50 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD LC1	MEMB.	FORCE
	(LBS)	(PLF)		(LBS)
FR-TO		FROM TO	FR-TO	
H-B	-311	0.0	0.0	0.03 (1)
A-B	0	35	-91.8	-91.8 0.14 (5)
B-C	-98	0	-91.8	-91.8 0.05 (1)
C-D	-105	0	-91.8	-91.8 0.05 (1)
H-G	0	0	-18.5	-18.5 0.03 (4)
F-G	0	15	0.0	0.0 0.01 (1)
G-C	-202	0	0.0	0.0 0.01 (1)
F-E	0	4	-18.5	-18.5 0.01 (4)

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9. NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018 . OBC 2012 . ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (A-B-S); BC=0.03/1.00 (G-H-4);
WB=0.08/1.00 (D-E-1); SS=0.09/1.00 (A-B-S)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.22 (B) INPUT = 0.50 ;
JSI METAL= 0.07 (C) INPUT = 1.00 ;



Structural component only
DWG# T-2007599

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	J20S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 10:03:51 2020 Page 1
ID:DMCubINVR6TstF0e31v6l_zns1H0v4McUDJ8C2IAIT_X7SGzA59ZPAq_xD41uHMEMs

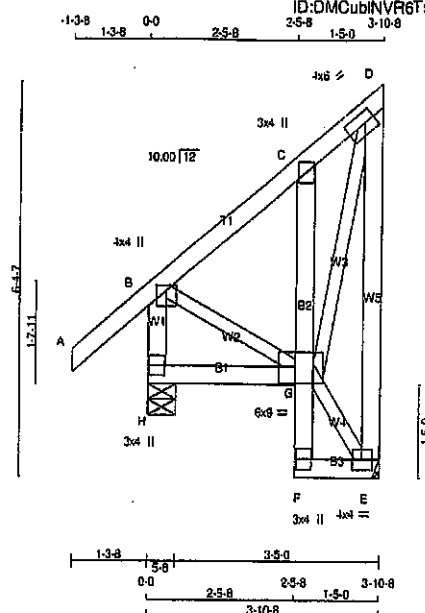

Scale = 1/32" = 1'-0"

LUMBER TOTAL WEIGHT = 2 X 33 = 66 lb

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
H - B	2x4	DRY	No.2	SPF
H - D	2x4	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF
F - C	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TMV+p	MT20	3.0	4.0		
D	TMVW+1	MT20	4.0	6.0	2.00	2.00
E	BMVW+1	MT20	4.0	4.0		
F	BMV+p	MT20	3.0	4.0		
G	BMVW+1	MT20	6.0	9.0	3.25	3.50
H	BMV+1	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

	FACTORED		MAXIMUM FACTORED		INPUT	REQD
JT	GROSS REACTION		GROSS REACTION		BRG	BRG
	VERT	HORIZ	DOWN	HORIZ	UPLIFT	IN-SX
H	333	0	333	0	0	5-8
E	206	0	206	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS							
	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SO
H	233	166 0	0 0	0 0	0 0	67 0	0
E	145	95 0	0 0	0 0	0 0	50 0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
H-B	-309 0	0.0	0.0 0.03 (1)	7.81	B-G	0 70	0.02 (1)
A-B	0 41	-91.8	-91.8 0.14 (5)	10.00	E-D	-185 0	0.08 (1)
B-C	-70 0	-91.8	-91.8 0.07 (1)	6.25	G-E	-13 0	0.00 (1)
C-D	-92 0	-91.8	-91.8 0.06 (1)	6.25	G-D	0 215	0.05 (1)
H-G	0 0	-18.5	-18.5 0.04 (4)	10.00			
F-G	0 12	0.0	0.0 0.02 (1)	10.00			
G-C	-216 0	0.0	0.0 0.02 (1)	7.81			
F-E	0 8	-18.5	-18.5 0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14 (A-B-S), BC=0.04 (G-H-I), WB=0.08 (1.00) (D-E:1), SS=0.09 (1.00) (A-B-S)

DOL LUMBER-1.00 NAIL-1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN	MAX
MT20	818	354	1687	788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (B) (INPUT = 0.90)
JSI METAL = 0.08 (C) (INPUT = 1.00)

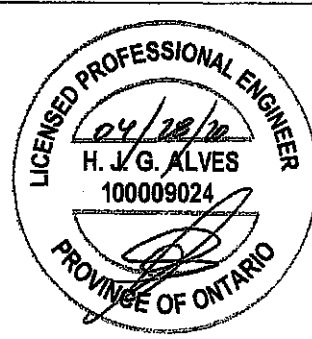


Structural component only
DWG# T-2007623

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408223	J21	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 26 10:03:53 2020 Page 1
ID:DMCubINVR6TstFoe31v6L_zns11-hP0qnlWUqmTmXUS8aPZUYh3VGyCuebnDgOW?oAzMEMo

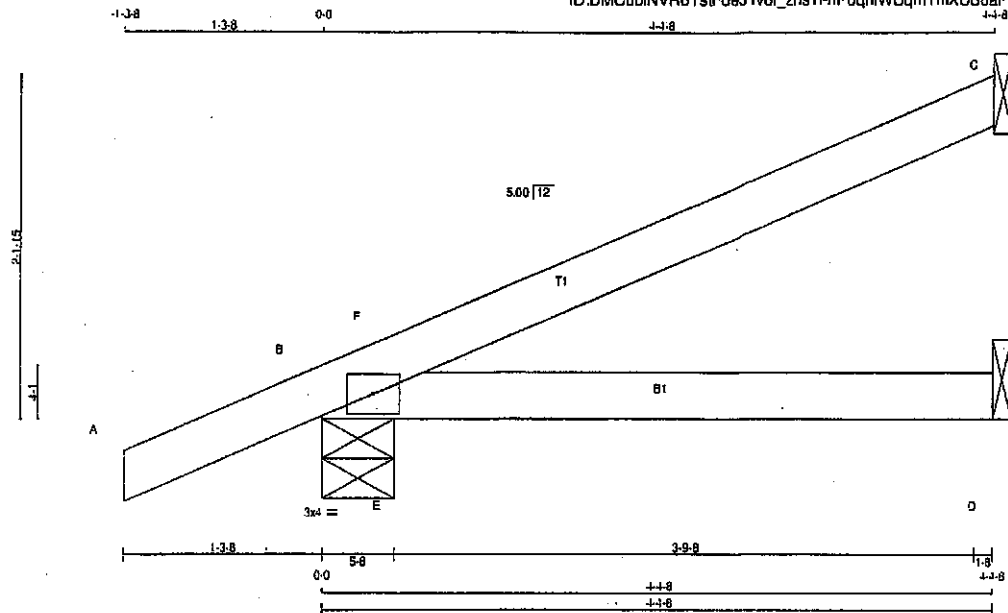

TOTAL WEIGHT = 4 X 12 = 49 lb [M]

LUMBER	DESCR.
N. L. G. A. RULES	
CHORDS SIZE	LUMBER
A - C 2x4 DRY No.2	
B - D 2x4 DRY No.2	
DRY: SEASONED LUMBER.	

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE PLATES				
B TMB1-MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
C	175	0	175	0
B	365	0	365	0
D	67	0	67	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS	1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
C	121	94 0 0 0 0 0 0 0
B	256	181 0 0 0 0 0 0 0
D	50	18 0 0 0 0 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. CS1 (LC)	UNBRAC LENGTH FR-TO	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
A-B	0	23	-91.8	-91.8	0.12 (1)	10.00	E-F	-235	7
B-F	-17	13	-91.8	-91.8	0.04 (4)	6.25			
F-C	-1	2	-91.8	-91.8	0.23 (1)	10.00			
B-E	0	0	-18.5	-18.5	0.16 (1)	10.00			
E-D	0	0	-18.5	-18.5	0.16 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA D86-09, CSA D86-14
- TPIC 2011, TPIC 2014

(55 % OF 31.5 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CS1: TC=0.23/1.00 (C-F:1), BC=0.16/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SS1=0.19/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.26 (B) (INPUT = 0.30)
JSI METAL= 0.07 (B) (INPUT = 1.00)

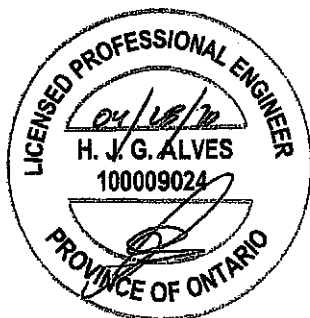

Structural component only
DWG# T-2007624

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408223	J22	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:03:54 2020 Page 1
ID:DMCubINVRE6TstFoe31v6I zns11-AbaD eX6b3bd9e1K874j4ubgtMZPN21Nv2FYKczMEMp

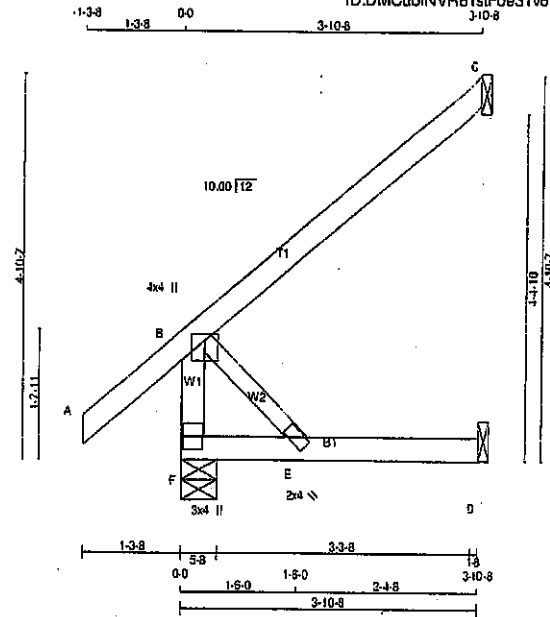

Scale = 1:27.0

TOTAL WEIGHT = 3 X 15 = 45 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT TYPE	PLATES	W.	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
E	BMVW+w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
F	341	0	341	0
C	178	0	178	0
D	38	0	40	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS	1ST LC CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED						
F	239	170	0	0	0	68	0
C	122	99	0	0	0	23	0
D	29	0	0	0	0	29	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	UNBRAC LENGTH	FR-TO			
F-B	-305 0	0.0 0.0	0.03 (1)	B-E	0 0	0.00 (1)	
A-B	0 41	-91.8 -91.8	0.14 (5)				
B-C	0 0	-91.8 -91.8	0.23 (1)				
F-E	0 0	-18.5 -18.5	0.08 (4)				
E-D	0 0	-18.5 -18.5	0.08 (4)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA C88-09, CSA C88-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.01")

CSI: TC=0.23/1.00 (B-C:1), BC=0.08/1.00 (D-E:4),

WB=0.00/1.00 (B-E:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1967 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (B) (INPUT = 0.50)
JSI METAL = 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007625

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	J40	2	1	GREEN PARK HOMES	
				TRUSS DESC.	

Tamareck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:19:52 2020 Page 1
ID:DMCubINVR6TstFoe31v6I zns11-6uTN2C71 PHh5aGSGJGMvwHM_XXOqKBNC5Jfy4zME7r

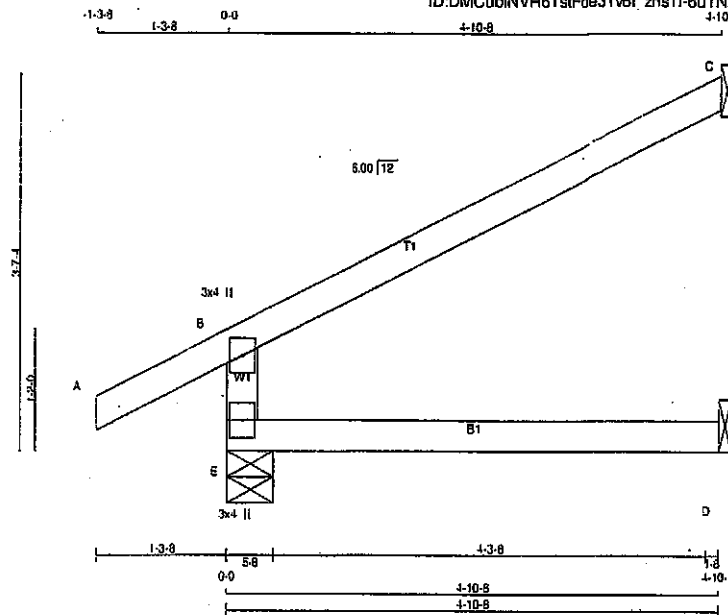

Scale = 1:20.5

TOTAL WEIGHT = 2 X 14 = 28 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
E	456	0	456	0
C	168	0	168	0
D	38	0	42	0

SEE MTEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED						
E	320	225	0	0	0	95	0
C	116	94	0	0	0	22	0
D	30	0	0	0	0	30	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	MEMB.	FORCE
	(LBS)	(LBS)		(LBS)
FR-TO		FROM TO	FR-TO	
E-B	-404	0	0	0
A-B	0	28	-91.8	-91.8
B-C	-25	0	-91.8	-91.8
E-D	0	0	-18.5	-18.5

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2015
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.37 (B-C:1), 8C=0.09 (D-E:4),
WB=0.00 (1.00 (max)), SSI=0.20 (1.00 (B-C:1))
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1686

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.17 (E) (INPUT = 0.90)
JSI METAL = 0.11 (B) (INPUT = 1.00)

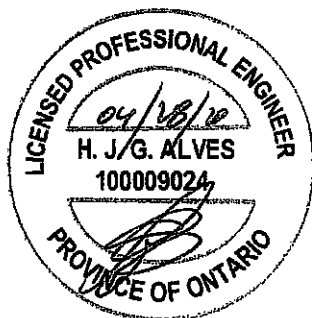


Structural component only
DWG# T-2007657

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	J41	5	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

ID:DMCubINVR6TstFos31v6I zns1i-3Hb7Tu8HW1XPKAQqNkQq_LMmiLEmEngfPoM1zzME7p

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:54 2020 Page 1

Scale = 1:17.8

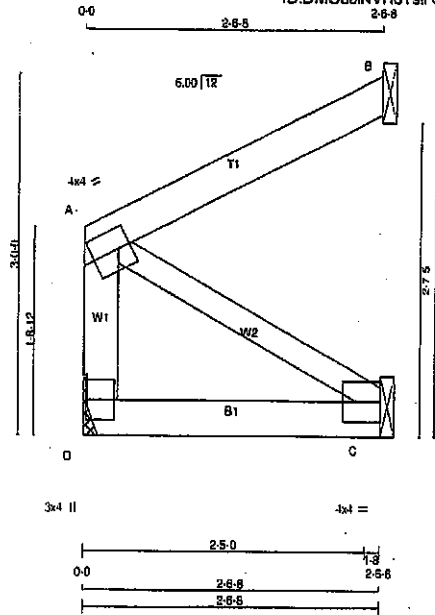

TOTAL WEIGHT = 5 X 10 = 49 lb [M][F]

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
D - A	2x4 DRY	No.2	SPF
A - B	2x4 DRY	No.2	SPF
D - C	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMVW-1	MT20	4.0	4.0 2.00 1.25
C	BMV1-1	MT20	4.0	4.0 2.00 Edge
D	BMV1-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
D	139	0	139	0	0	MECHANICAL			
B	117	0	117	0	0	1-8	1-8		
C	23	0	25	0	0	1-8	1-8		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	98	65 0	0 0	0 0	0 0	33 0	0 0	0 0
B	80	65 0	0 0	0 0	0 0	15 0	0 0	0 0
C	18	0 0	0 0	0 0	0 0	18 0	0 0	0 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX. (PLF)	MEMB.	FORCE (LBS)	MAX. (PLF)	LC1
FR-TO		FROM	TO	FR-TO		FROM	TO
D-A	-117 0	0.0	0.0 0.01 (1)	7.81	A-C	0 0	0.00 (1)
A-B	0 0	-91.8	-91.8 0.10 (1)	10.00			
D-C	0 0	-16.5	-16.5 0.03 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.10/1.00 (A-B:1), BC=0.03/1.00 (C-D:4),
WB=0.00/1.00 (A-C:1), SG=0.00/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1997 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.07 (A) INPUT = 0.00
JSI METAL = 0.02 (A) INPUT = 1.00




Structural component only
DWG# T-2007658

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	J42	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:55 2020 Page 1
ID:DMCubINVR6TstFoe31v6I zns1I-X78WgE9vHKIGyK71xSq3XYumIX 1hxqu3YvZPzME7C

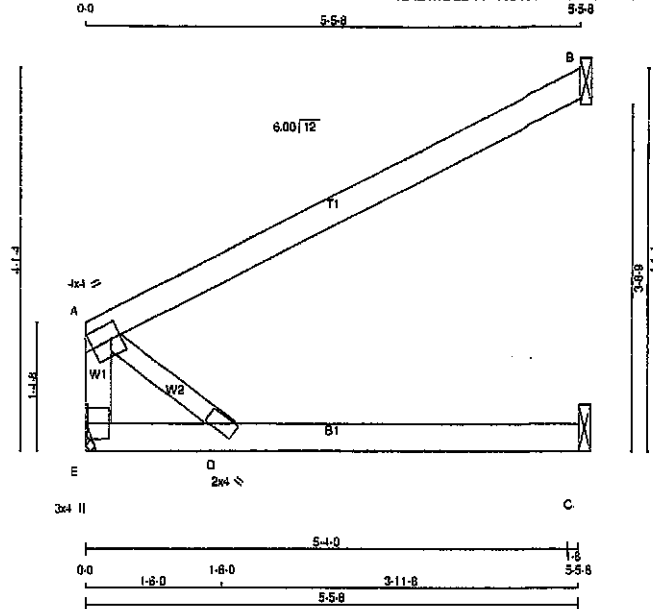

TOTAL WEIGHT = 2 X 16 = 31 lb (M/F)

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - A	2x4	DRY	No.2	SPF
A - B	2x4	DRY	No.2	SPF
E - C	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	4.0	4.0	2.00	1.25
D	BMVW-w	MT20	2.0	4.0		
E	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
E	301	0	301	0
B	250	0	250	0
C	50	0	57	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

SEE MITEK STANDARD DETAIL B97791 H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
E	213	140.0	0.0	0.0	0.0	78.0	0.0
B	172	140.0	0.0	0.0	0.0	33.0	0.0
C	40	0.0	0.0	0.0	0.0	40.0	0.0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO		FR-TO			
E-A	-250.0	0.0	0.0 0.03 (1)	A-D	0.0	0.00 (1)	
A-B	0.0	-91.8	-91.8 0.46 (1)				
E-D	0.0	-18.5	-18.5 0.13 (4)				
D-C	0.0	-18.5	-18.5 0.16 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.46/1.00 (A-B:1), SC=0.16/1.00 (C-D:4), WB=0.00/1.00 (A-D:1), SSI=0.17/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	618	354	1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.15 (A) (INPUT = 0.90)
JSI METAL = 0.04 (A) (INPUT = 1.00)



Structural component only
DWG# T-2007659

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C40	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:42 2020 Page 1					
ID:DMCubINVR6TstFoe31v6I zns1l-Pzsbv0?ILL16uKVXgD50VpshpV5QuojwXujdzME8?					
Scale = 1:17.8					

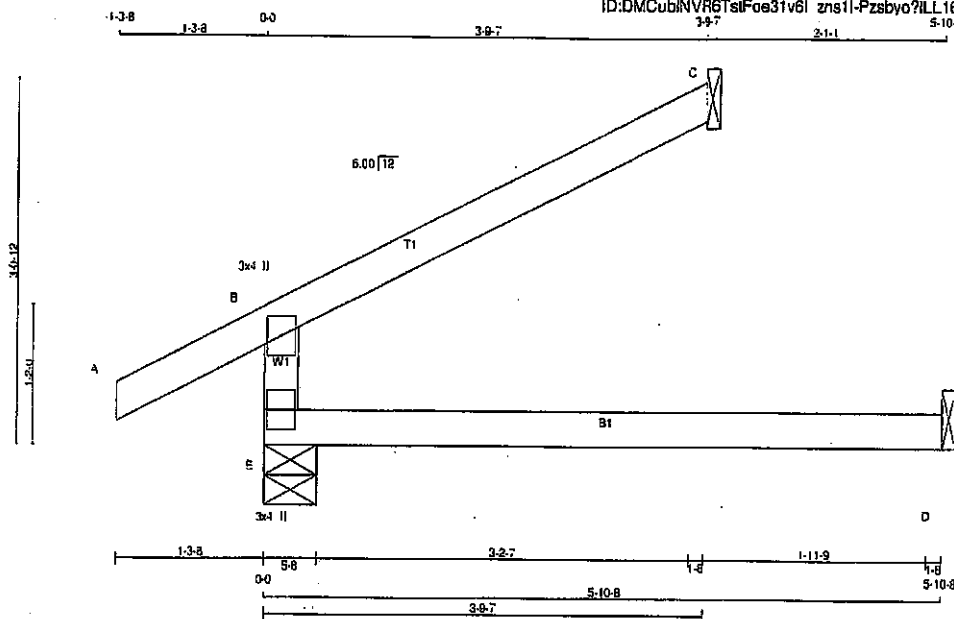

TOTAL WEIGHT = 2 X 14 = 28 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
E	405 0	405 0	5-8	5-8
C	130 0	130 0	1-8	1-8
D	45 0	50 0	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	288	190 0	0 0	0 0	0 0	98 0	0 0
C	90	73 0	0 0	0 0	0 0	17 0	0 0
D	38	0 0	0 0	0 0	0 0	36 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. VERT. LOAD (LC1)	MAX. HORIZ. LOAD (LC2)	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. HORIZ. LOAD (LC2)
FR-TO										
E-B		-342 0	0.0	0.0	0.13 (4)	7.81				
A-B		0 28	-91.8	-91.8	0.12 (1)	10.00				
B-C		-19 0	-91.8	-91.8	0.22 (1)	6.25				
E-D		0 0	-18.5	-18.5	0.13 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (A-B:0), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (IN)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1687
	788	1937	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E1) / INPUT = 0.90
JSI METAL = 0.09 (B) / INPUT = 1.00




Structural component only
DWG# T-2007648

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408224	C41	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:44 2020 Page 1
ID:DMCubINVR6TstFoe3Iv6t zns1I-LM MNT0?yHq7dfv0e7UaEx3uJnoyIDCMrNqgYzME7z
5-10-8

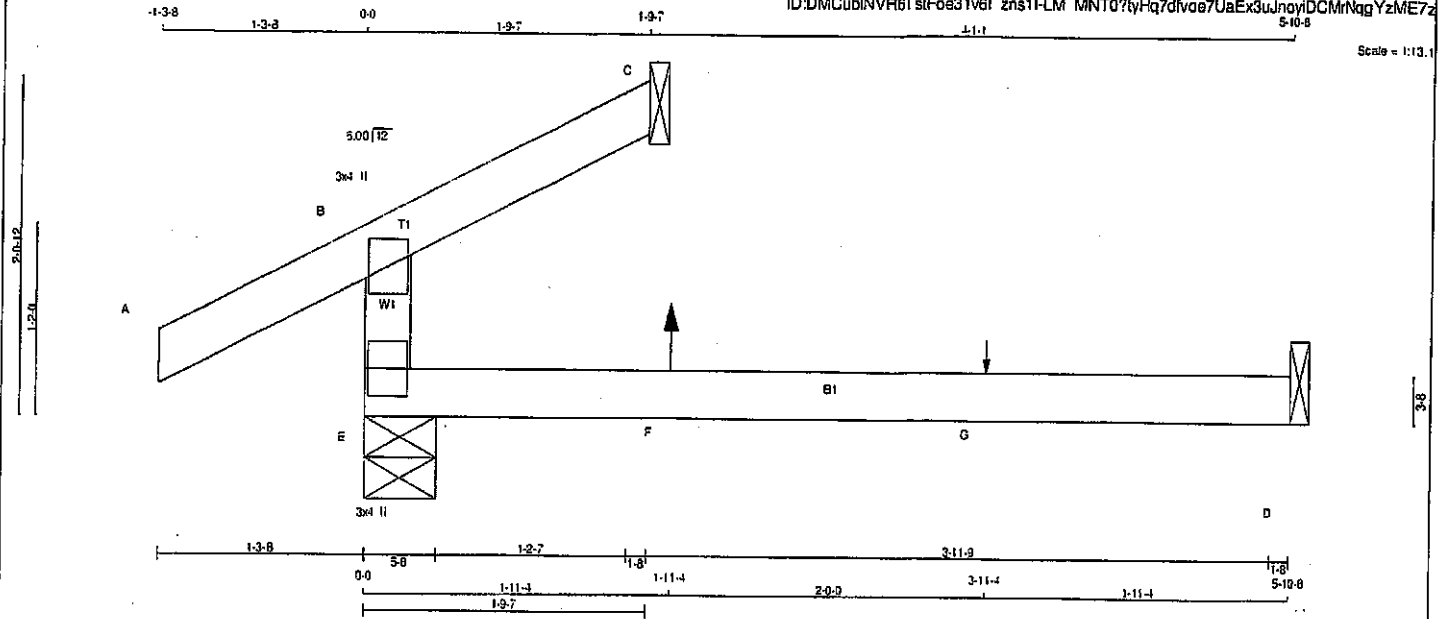

LUMBER				DESIGN CRITERIA			
N L G A RULES				SPECIFIED LOADS:			
CHORDS	SIZE	DRY	LUMBER	TOP CH. LL	=	25.6	PSF
E - B	2x4	DRY	No.2	DL	=	6.0	PSF
A - C	2x4	DRY	No.2	BOT CH. LL	=	0.0	PSF
E - D	2x4	DRY	No.2	DL	=	7.4	PSF
DRY: SEASONED LUMBER.				TOTAL LOAD	=	39.0	PSF

PLATES (tablets in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
E BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS				UNFACTORED REACTIONS			
	FACTORED	MAXIMUM	FACTORED	1ST CASE	MAX. MIN.	COMPONENT	REACTIONS
	GROSS REACTION	DOWN	GROSS REACTION	JT COMBINED	SNOW	LIVE	PERM. LIVE
JT	VERT	HORZ	UPLIFT	E	200	137	0
E	284	0	284	C	46	21	0
C	63	0	63	D	35	0	3
D	44	0	52				

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C							
BRACING							
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.							
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.							
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.							
LOADING							
TOTAL LOAD CASES: (7)							

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (7)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
E-B	-227	0	0.0	0.0	0.11	(4)	7.81
A-B	0	28	-91.8	-91.8	0.12	(1)	10.00
B-C	-9	9	-91.8	-91.8	0.08	(4)	10.00
E-F	0	0	-18.5	-18.5	0.14	(4)	10.00
F-G	0	0	-18.5	-18.5	0.14	(4)	10.00
G-D	0	0	-18.5	-18.5	0.14	(4)	10.00

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE
F	1-11-4	7	1	12	BACK	VERT	TOTAL
G	3-11-4	1	1	12	BACK	VERT	TOTAL

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=0.99 NAIL=0.98 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007649

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C42	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:19:45 2020 Page 1
ID:DMCubINVR6TsiFoe31v6I zns11-pYYkap1eeGPhnE6LLej7RUC2j9wh9SMbV7NC zME7y

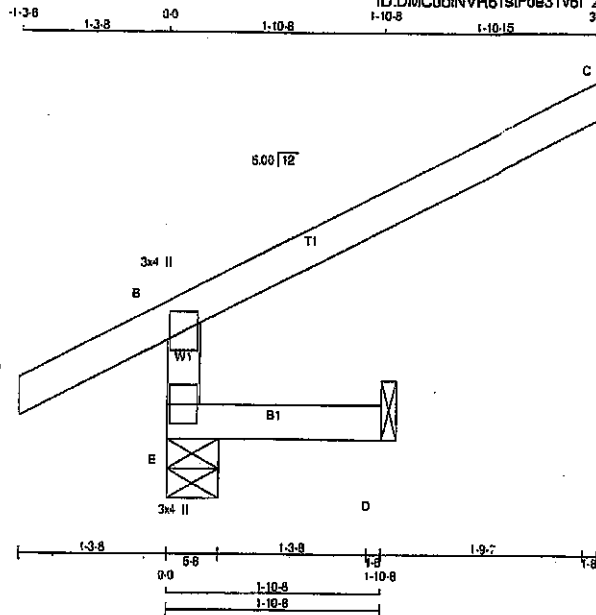

Scale = 1:18.2

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS	2x4	DRY	No.2
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY, SEASONED LUMBER.

PLATES (tablets in inches)			
JT TYPE	PLATES	W	LEN Y X
B TMV+p	MT20	3.0	4.0
E BMV+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	
E	361 0	361 0	5-8	5-8	
C	130 0	130 0	1-8	1-8	
D	18 0	17 0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS					
JT	1ST LOASE	SNOW	MAX. MIN. COMPONENT REACTIONS	LIVE	PERM. LIVE
E	250	190 0	0 0	0 0	0 0
C	90	73 0	0 0	0 0	0 0
D	12	0 0	0 0	0 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (6)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
E-B	-342 0	0.0 0.0 0.01 (4)	7.81				
A-B	0 28	-91.8 -91.8 0.13 (5)	10.00				
B-C	-19 0	-91.8 -91.8 0.22 (1)	6.25				
E-D	0 0	-18.5 -18.5 0.02 (4)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CS1: TC=0.22(1.00 (B-C:1), BC=0.02(1.00 (D-E:4), WB=0.00(1.00 (m:a:3), SS1=0.15(1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007650

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C43	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 9.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:19:46 2020 Page 1
ID=DMCubINVR6TstF0e31v6l_zns11-lk66o92GPaxYNxplv39yft10Q6VqQoIVq9sxlRzME7x

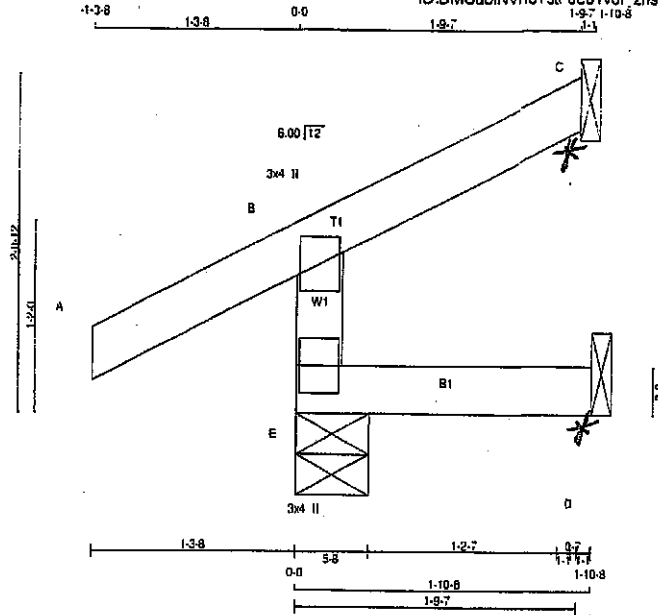

Scale = 1/13.1

LUMBER			
N L G A RULES	SIZE	LUMBER	DESCR.
CHORDS			
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
E	TMV+p	MT20	3.0	4.0
B	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	BRG	IN-SX	BRG	IN-SX
E	271	0	271	0	0	5-8	5-8	5-8	5-8
C	45	0	45	0	-23	1-8	1-8	1-8	1-8
D	8	0	17	0	-2	1-8	1-8	1-8	1-8

SEE MTEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS		LIVE		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW
E	188	141	0	0	0	0	0	0	0	47	0	0	0
C	31	24	-18	0	0	0	0	0	0	7	0	0	0
D	7	0	-8	0	0	0	0	0	0	12	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		W E B S		FACTORED	
MEMB.	FORCE	VERT. LOAD	LC1 MAX	MEMB.	FORCE	VERT. LOAD	LC1 MAX
(LBS)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
E-B	-244	0	0.0	0.0	0.04	(5)	7.81
A-B	0	28	-91.8	-91.8	0.12	(1)	10.00
B-C	-17	0	-91.8	-91.8	0.09	(1)	6.25
E-D	0	0	-18.5	-18.5	0.04	(5)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5), WB=0.00/1.00 (n/a:2), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667
	789	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.10 (EI) INPUT = 0.90
JSI METAL = 0.07 (EI) INPUT = 1.00



Structural component only
DWG# T-2007651

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C44	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 10:19:47 2020 Page 1
ID:DMCubINVR6TstFoe31v6L zns11-mxgU?V3uAtfP SOUTmhBCsZXYWqD93ye2pcUHizME7v

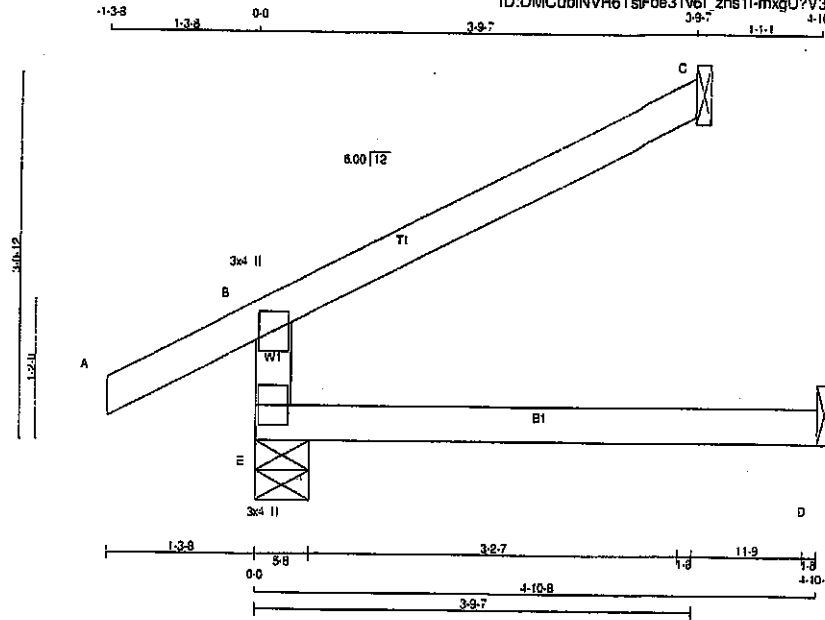

Scale = 1:17.9

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	SPF
A - C	2x4	DRY	SPF
E - D	2x4	DRY	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
E	394	0	394	0	5-8
C	130	0	130	0	1-8
D	38	0	42	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
E	277	190	0	0	0	0	0	87	0
C	90	73	0	0	0	0	0	17	0
D	30	0	0	0	0	0	0	30	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)		CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MAX. UNBRAC	MEMB.	FORCE MAX
FR-TO		FROM	TO	LENGTH	FR-TO	
E-B	342	0	0.0	0.08 (4)	7.61	
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00
B-C	-19	0	-91.8	-91.8	0.22 (1)	6.25
E-D	0	0	-18.5	-18.5	0.08 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.22:1.00 (B-C:1), BC=0.09:1.00 (D-E:4), WB=0.00:1.00 (max:0), SSI=0.15:1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.14 (E) INPUT = 0.90
JSI METAL= 0.09 (B) INPUT = 1.00

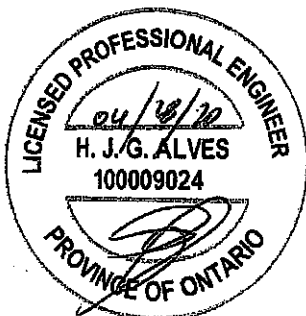

Structural component only
DWG# T-2007652

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C45	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 10:19:48 2020 Page 1
ID:DMCubINVR6TstFoe31v6t_zns11-E7DsCr3WxBnFcFyg1UCQ48kewwAMuWCotHL1pJzME7v

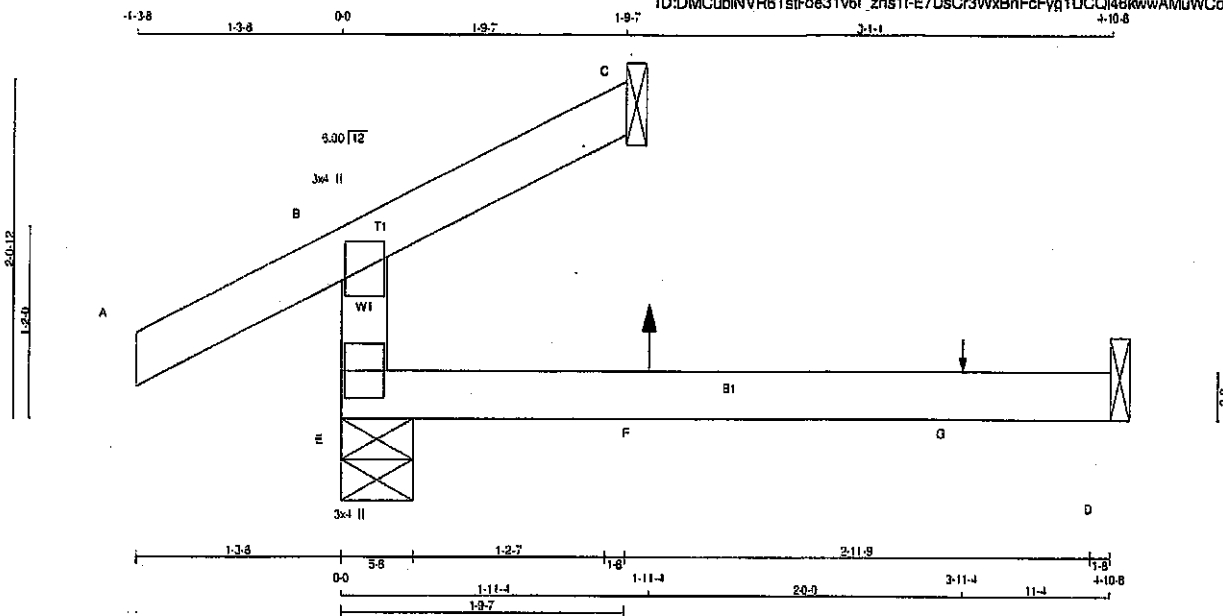

TOTAL WEIGHT = 2 X 10 = 21 lb

LUMBER	N L G A RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0			
E	BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		RECORD BRG	
	VERT	HORZ	DOWN	UP	IN-SX	IN-SX	IN-SX	IN-SX
E	282	0	282	0	5-8	5-8		
C	55	0	55	0	1-8	1-8		
D	35	0	44	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
		DOWN	UP						
E	198	137	0	0	0	0	0	61	0
C	39	21	0	0	0	0	0	18	0
D	29	0	-4	0	0	0	0	31	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: 171

MEMB.	FR-TO	CHORDS		FACTORED		WESS		MAX. FACTORED	
		FORCE (LBS)	VERT. LOAD (LBS)	MAX. (LBS)	MIN. (LBS)	MAX. (LBS)	MIN. (LBS)	FORCE (LBS)	MAX. (LBS)
E-B		-235	0	0.0	0.0	0.07 (4)	7.81		
A-B		0	25	-91.8	-91.8	0.12 (1)	10.00		
B-C		-13	5	-91.8	-91.8	0.07 (5)	6.25		
E-F		0	0	-18.5	-18.5	0.10 (4)	10.00		
F-G		0	0	-18.5	-18.5	0.10 (4)	10.00		
G-D		0	0	-18.5	-18.5	0.10 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11-4	7	1	12	BACK	VERT	TOTAL	---	C1
G	3-11-4	1	1	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CS: TC=0.12/1.00 (A-B:1) . BC=0.10/1.00 (D-E:4) .
WB=0.00/1.00 (n/a:0) . SS=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 L3 BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007653

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C46	1	1	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 10:19:49 2020 Page 1
ID:DMCubINVR6TstFoe31v6I zns11-ljnEQB48hUv6EPXlaBjHHfuKKVjdZSxW75bLzME7u

Scale = 1:18.2

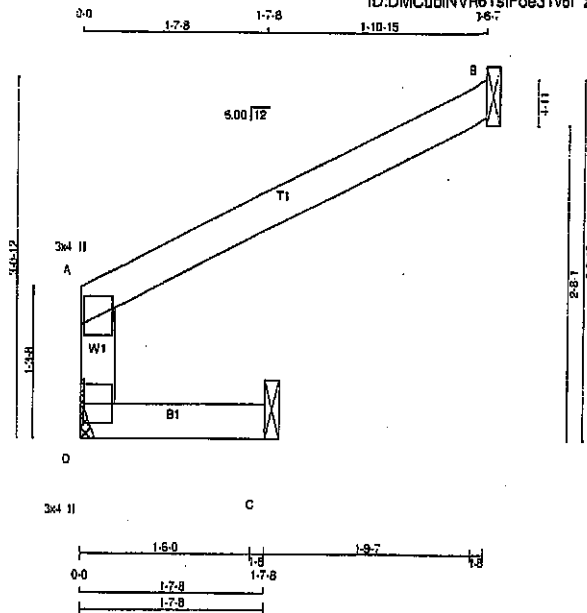

LUMBER			
N.L.G.A. RULES	SIZE	LUMBER	DESCR.
CHORDS			SPF
D - A	2x4 DRY	No.2	SPF
A - B	2x4 DRY	No.2	SPF
D - C	2x4 DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	V X
A	TMV+p	MT20	3.0	4.0	
D	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED		MAXIMUM FACTORED		INPUT	REQD	
	GROSS REACTION		GROSS REACTION		BRG	BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
D	156	0	156	0	0	MECHANICAL	
B	144	0	144	0	0	1-8	1-8
C	55	0	55	0	0	1-8	1-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL 887791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS							
JT	1ST LCASE COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	109	78 0	0 0	0 0	0 0	31 0	0 0
B	99	80 0	0 0	0 0	0 0	19 0	0 0
C	40	23 0	0 0	0 0	0 0	17 0	0 0

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO				FR-TO			
D-A	-181 0	0.0	0.0 0.09 (1)	7.81			
A-B	-8 0	-91.8	-91.8 0.14 (1)	10.00			
D-C	0 0	-18.5	-18.5 0.09 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
CL = 8.0 PSF
BOT CH. LL = 0.0 PSF
CL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (A-B:1), BC=0.09/1.00 (C-D:1), WB=0.00/1.00 (max:0), SSI=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.08 (D) (INPUT = 0.99)
JSI METAL = 0.05 (A) (INPUT = 1.00)



Structural component only
DWG# T-2007654

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408224	C47	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MTK Industries, Inc. Tue Apr 28 10:19:50 2020 Page 1

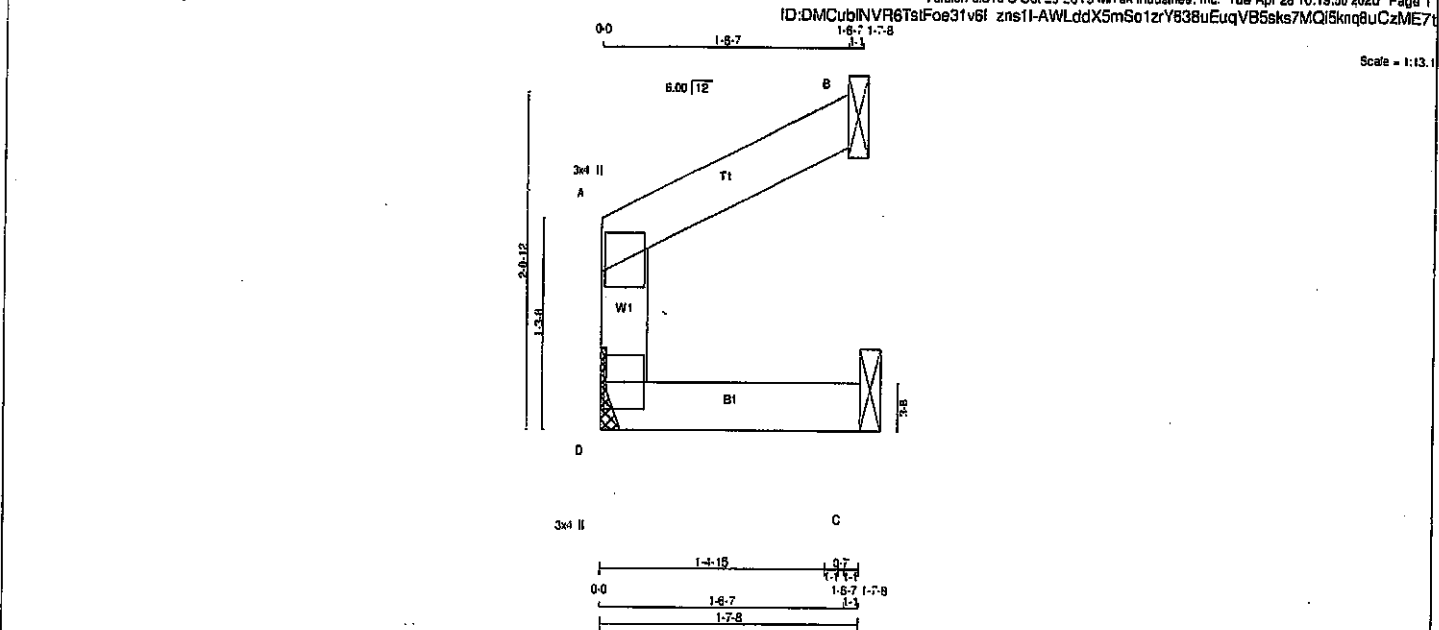

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
D - A	2x4 DRY	No.2	SPF
A - B	2x4 DRY	No.2	SPF
D - C	2x4 DRY	No.2	SPF

DRY, SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMV+p	MT20	3.0	4.0
D	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	VERT	GROSS REACTION	HORZ	DOWN	UP	BRG	BRG	IN-SX	IN-SX
D	88	0	88	0	0	1-8	1-8	1-8	1-8
B	67	0	67	0	0	1-8	1-8	1-8	1-8
C	19	0	19	0	0	1-8	1-8	1-8	1-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
D	61	39 0	0 0	0 0	0 0
B	46	37 0	0 0	0 0	0 0
C	14	2 0	0 0	0 0	0 0

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	FORCE (LBS)	MAX (LC)	UNBRAC LENGTH
FR-TO		FROM	TO	FR-TO			
D-A	-74 0	0.0	0.0 0.01 (1)	7.81			
A-B	-2 0	-91.8	-91.8 0.03 (1)	10.00			
D-C	0 0	-18.5	-18.5 0.01 (4)	10.00			

TOTAL WEIGHT = 5 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.03, 1.00 (A-B:1), BC=0.01, 1.00 (C-D:4), WB=0.00, 1.00 (A-D:0), SS=0.05, 1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.03 (D) (INPUT = 0.90)
JSI METAL = 0.02 (A) (INPUT = 1.00)



Structural component only
DWG# T-2007655

LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.


Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1 1/4" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.




Double-Shear
Nailing
Top View




Double-Shear
Nailing
Side View;
Do not
bend tab




Dome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,580

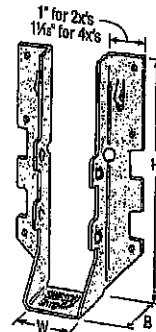


✓ LUS28




LU26L

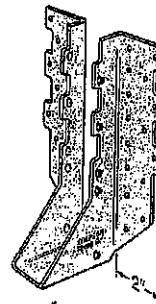


✓ HUS210
(HUS26, HUS28,
and HHUS similar)



✓ HGUS28-2




✓ HHUS210-2



LJS26DS

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

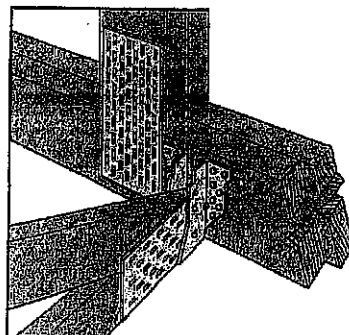

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
$W < 2"$	Bevel or square cut	0.62 of table value	0.46 of table value
$2" < W < 6"$	Bevel cut	0.67 of table value	0.41 of table value
$2" < W < 6"$	Square cut	0.46 of table value	0.41 of table value
$W > 6"$	Bevel cut	0.75 of table value	0.41 of table value

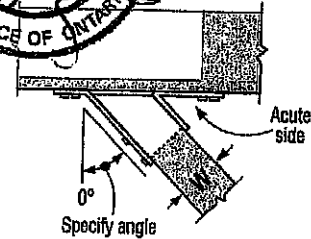

Top View HHUS Hanger Skewed Right
(joist must be bevel cut)
All joist nails installed on the outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _s ³	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb.	(K _D = 1.00) lb.	(K _D = 1.15) lb.	(K _D = 1.00) lb.
Single 2x Sizes											
LUS24	18	1 1/8	3 1/2	1 1/2	2 1/4	(4) 10d	(2) 10d	710	1625	645	1155
								3.16	7.23	2.87	5.14
LU24L	22	1 1/8	3	1 1/2	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360	1020	320	725
								1.60	4.54	1.42	3.22
LU26L	22	1 1/8	5	1 1/2	4 1/2	(6) 10d	(4) 10d x 1 1/2"	720	1605	645	1140
								3.20	7.14	2.87	5.07
LUS26	18	1 1/8	4 1/2	1 1/2	3 3/4	(4) 10d	(4) 10d	1420	2170	1290	1630
								6.32	9.65	5.74	7.25
HUS26	18	1 1/8	5 1/2	3	3 1/8	(14) 16d	(6) 16d	2705	4940	2065	3875
								11.80	21.97	9.20	17.24
LJS26DS	18	1 1/8	5	3 1/2	4 1/2	(16) 16d	(6) 16d	2055	4265	1460	4115
								9.14	18.97	6.49	18.31
HGUS26	12	1 1/8	5 1/2	5	4 1/2	(20) 16d	(8) 16d	2685	6625	2685	5700
								11.96	29.51	11.96	25.35
LU28L	20	1 1/8	6 1/2	1 1/2	5 1/2	(8) 10d	(6) 10d x 1 1/2"	1140	2185	1020	1550
								5.07	9.72	4.54	6.89
LUS28	18	1 1/8	6 1/2	1 1/2	3 3/4	(6) 10d	(4) 10d	1420	2520	1290	1790
								6.32	11.21	5.74	7.96
HUS28	16	1 1/8	7 1/2	3	6 1/8	(22) 16d	(8) 16d	3605	5365	2675	4345
								16.04	23.88	11.90	19.33
HGUS28	12	1 1/8	7 1/2	5	6 1/2	(36) 16d	(12) 16d	3310	7675	3310	6900
								14.74	34.19	14.74	30.73
LU210L	20	1 1/8	8	1 1/2	7 1/2	(10) 10d	(6) 10d x 1 1/2"	1140	2495	1020	1770
								5.07	11.10	4.54	7.87
LUS210	18	1 1/8	7 1/8	1 1/2	3 3/4	(8) 10d	(4) 10d	1420	2785	1290	2210
								6.32	12.39	5.74	9.83

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/4" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)					Fasteners		Factored Resistance			
		W	H	B	d _a ³	Header	Joist		D-Fir-L		S-P-F	
									Uplift	Normal	Uplift	Normal
									(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
									lb.	lb.	lb.	lb.
									kN	kN	kN	kN
Double 2x Sizes												
LUS24-2	18	3 1/8	3 1/8	2	1 1/2	(4) 16d	(2) 16d		835	2020	590	1435
SS LUS26-2	18	3 1/8	4 1/8	2	4	(4) 16d	(4) 16d		3.71	8.99	2.62	6.38
									1720	2595	1545	1920
									7.65	11.54	6.87	8.54
HHUS26-2	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d		2850	7335	2065	5205
									12.68	32.83	9.20	23.15
HGUS26-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d		4385	8950	3110	6355
									19.51	39.81	13.83	28.27
SS LUS28-2	18	3 1/8	7	2	4	(6) 16d	(4) 16d		1720	3325	1545	2675
									7.65	14.79	6.87	11.45
HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d		3765	8940	2675	6345
									16.75	39.77	11.90	28.22
HGUS28-2	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d		6070	12980	4310	9215
									27.00	57.74	19.17	40.99
SS LUS210-2	18	3 1/8	9	2	6	(8) 16d	(6) 16d		2580	4500	2320	3195
									11.48	20.02	10.32	14.21
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d		4670	9660	4235	7000
									20.77	42.97	18.84	31.14
HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d		6840	14015	4855	10270
									30.43	62.34	21.60	45.69
Triple 2x Sizes												
HGUS26-3	12	4 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d		4385	8950	3110	6355
									19.51	39.81	13.83	28.27
HGUS28-3	12	4 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d		6070	12980	4310	9215
									27.00	57.74	19.17	40.99
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d		4670	9670	4235	6865
									20.77	43.02	18.84	30.54
HGUS210-3	12	4 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d		6840	14645	4855	10400
									30.43	65.14	21.60	46.26
Quadruple 2x Sizes												
HGUS26-4	12	6 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d		4385	8950	3110	6355
									19.51	39.81	13.83	28.27
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d		6070	12980	4310	9215
									27.00	57.74	19.17	40.99
HHUS210-4	14	6 1/8	8 1/8	3	7 1/8	(30) 16d	(10) 16d		4670	10155	4235	7210
									20.77	45.17	18.84	32.07
HGUS210-4	12	6 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d		6840	14645	4855	10400
									30.43	65.14	21.60	46.26
HGUS212-4	12	6 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d		7640	14995	5425	10645
									33.98	66.70	24.13	47.35
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d		10130	16400	7195	11645
									45.06	72.95	32.00	51.80
4x Sizes												
LUS46	18	3 1/8	4 1/8	2	3 1/8	(4) 16d	(4) 16d		1720	2505	1545	1920
									7.65	11.54	6.87	8.54
HHUS46	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d		2540	7335	2065	5205
									11.30	32.83	9.20	23.15
HGUS46	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d		4385	8950	3110	6355
									19.51	39.81	13.83	28.27
LUS48	18	3 1/8	6 1/8	2	3 1/8	(6) 16d	(4) 16d		1720	3325	1545	2675
									7.65	14.79	6.87	11.45
HHUS48	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d		3765	8940	2675	6345
									16.75	39.77	11.90	28.22
HGUS48	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d		6070	12980	4310	9215
									27.00	57.74	19.17	40.99
LUS410	18	3 1/8	8 1/8	2	5 1/8	(8) 16d	(6) 16d		2580	4500	2320	3195
									11.48	20.02	10.32	14.21
HGUS410	12	3 1/8	9	4	8 1/8	(46) 16d	(16) 16d		6840	14015	4855	10270
									30.43	62.34	21.60	45.69
HGUS412	12	3 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d		7640	14995	5425	10645
									33.98	66.70	24.13	47.35
HGUS414	12	3 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d		10130	16400	7195	11645
									45.06	72.95	32.00	51.80



Plated Truss Connectors

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

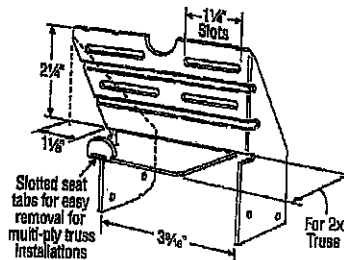


TC24
U.S. Patent 4,932,173

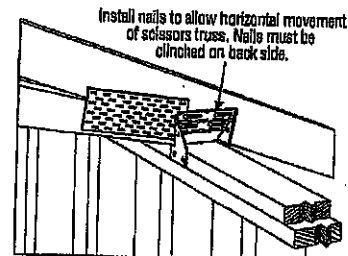


Typical TC24 Installation

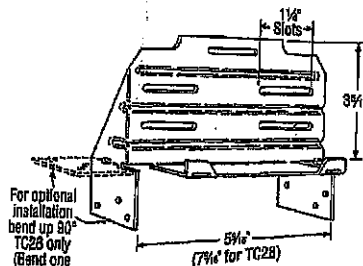

TC26
(TC28 Similar)

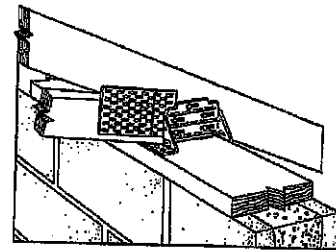

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer (8", 10", 12" Wall Installation Similar)

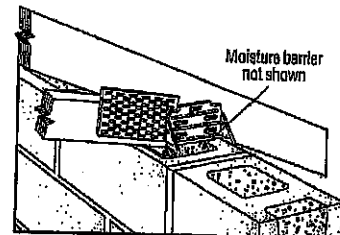

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L Uplift (K _u =1.15)	S-P-F Uplift (K _u =1.15)
			lb.	lb.
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L Uplift (K _u =1.15)	S-P-F Uplift (K _u =1.15)
			lb.	lb.
TC26	(5) 10d	(6) 10d x 1 1/2"	810	660
	(5) 10d	(6) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.

2. Grout strength is 15 MPa minimum.

3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.

4. TC26 fastened to grouted concrete block with (8) - 3/4" x 2 1/4" Titen screws has a factored uplift resistance of 275 lb.



DESIGN

For more information, visit us online at www.simpsonstrongtie.com or call 1-800-999-5099. © 2017 Simpson Strong-Tie Company.

INSPECTOR: [Signature]

(800) 999-5099
strongtie.com

H/TSP**SIMPSON**
Strong-Tie**Seismic and Hurricane Ties (cont.)**

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_D = 1.15$)					
					D.Fir-L			S-P-F		
		To Rafters/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(6) 8d x 1½"	(4) 8d	—	740	685	300	680	485	216
					3.29	3.05	1.33	3.02	2.16	0.96
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	890	220	75	590	155	55
					3.99	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
					3.58	0.71	0.71	3.38	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	265	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ³	18	(5) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A ³	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	565	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^{7,8}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1465	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
		[2] (12) 8d x 1½"	(15) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
TSP	16	(9) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
					5.78	1.96	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.96	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-H/TIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 485 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.162" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27–28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

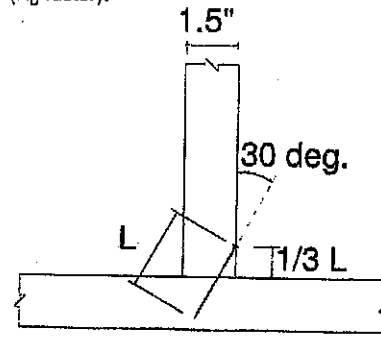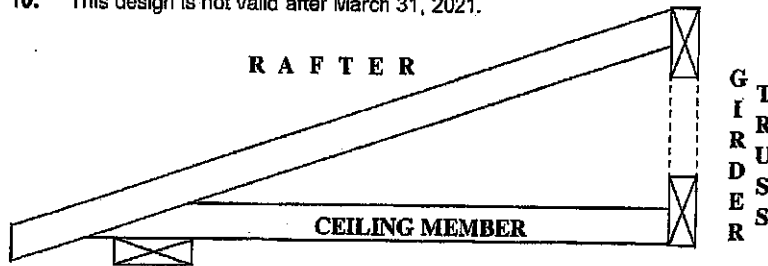

TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

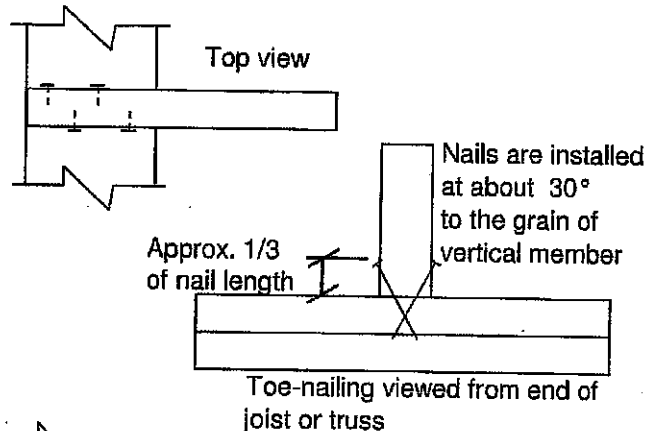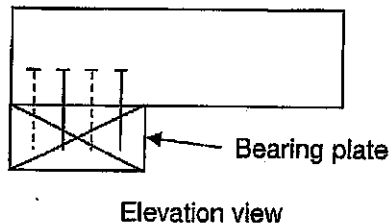

Toe-nailing on 2x4 Bearing Plate

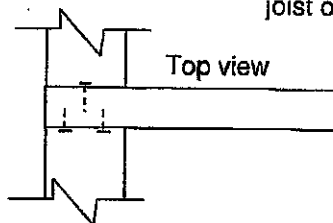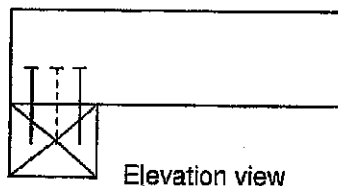


MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019




Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint, unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/8" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

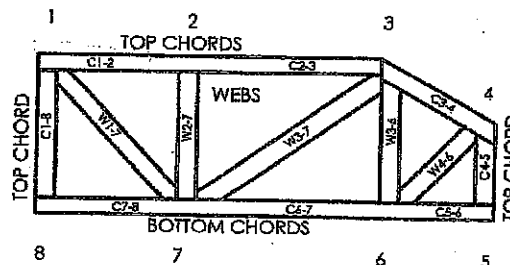

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MII-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never slack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane of joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

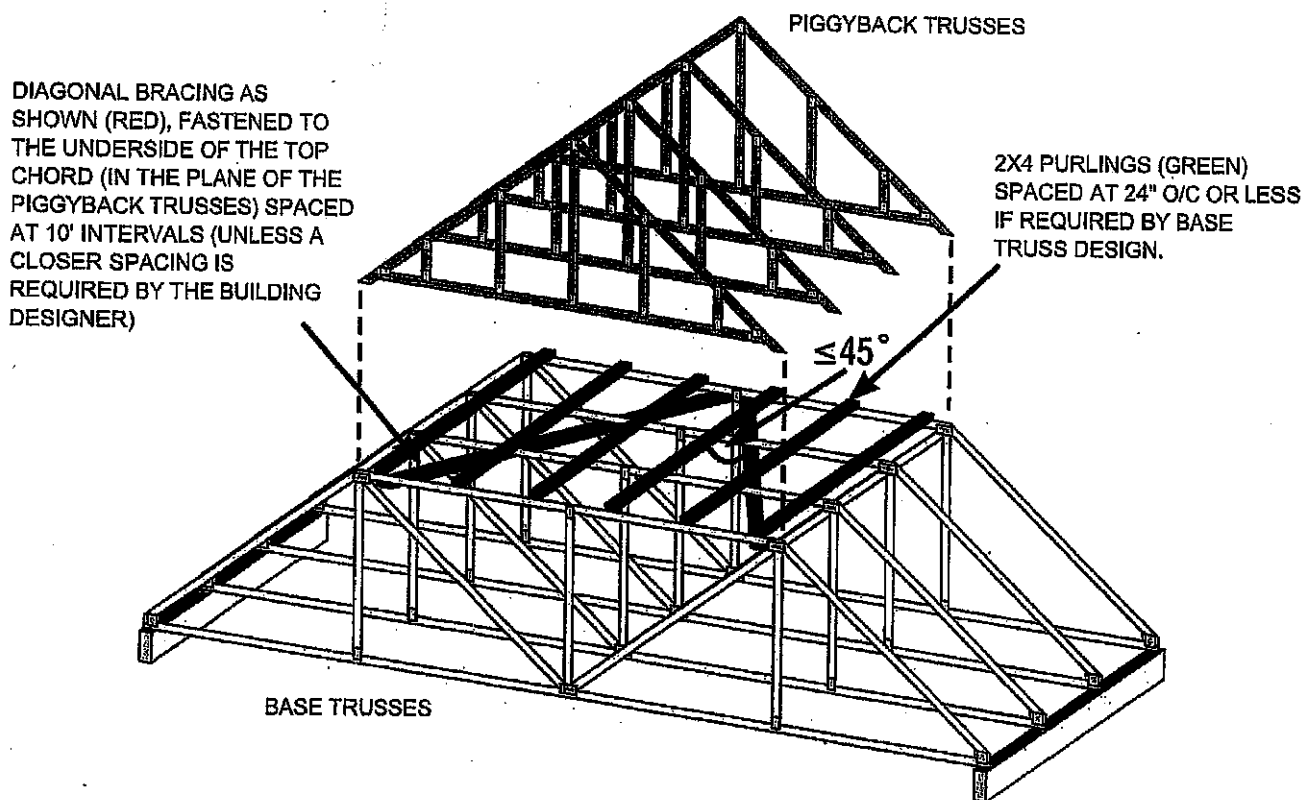


NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1800213

Feb 09, 2018