


ALL CONV. FRAMING TO CONFORM WITH PART 9 OF O.B.C.2012
(2019 AMENDMENT) ROOF RAFTERS THAT CROSS MEET OVER TRUSSES
TO BE 2X4SPF @ 24"O.C. WITH A 2X4 VERT. POST TO THE TRUSS
UNDER NEATH AT EACH CROSS PT. VERT. POST LONGER THAN 6"
TO HAVE LATERAL BRACING SO THAT THE DISTANCE BETWEEN
END PT. & BETWEEN ROWS OF BRACING DOES NOT EXCEED 6"

32-09-00

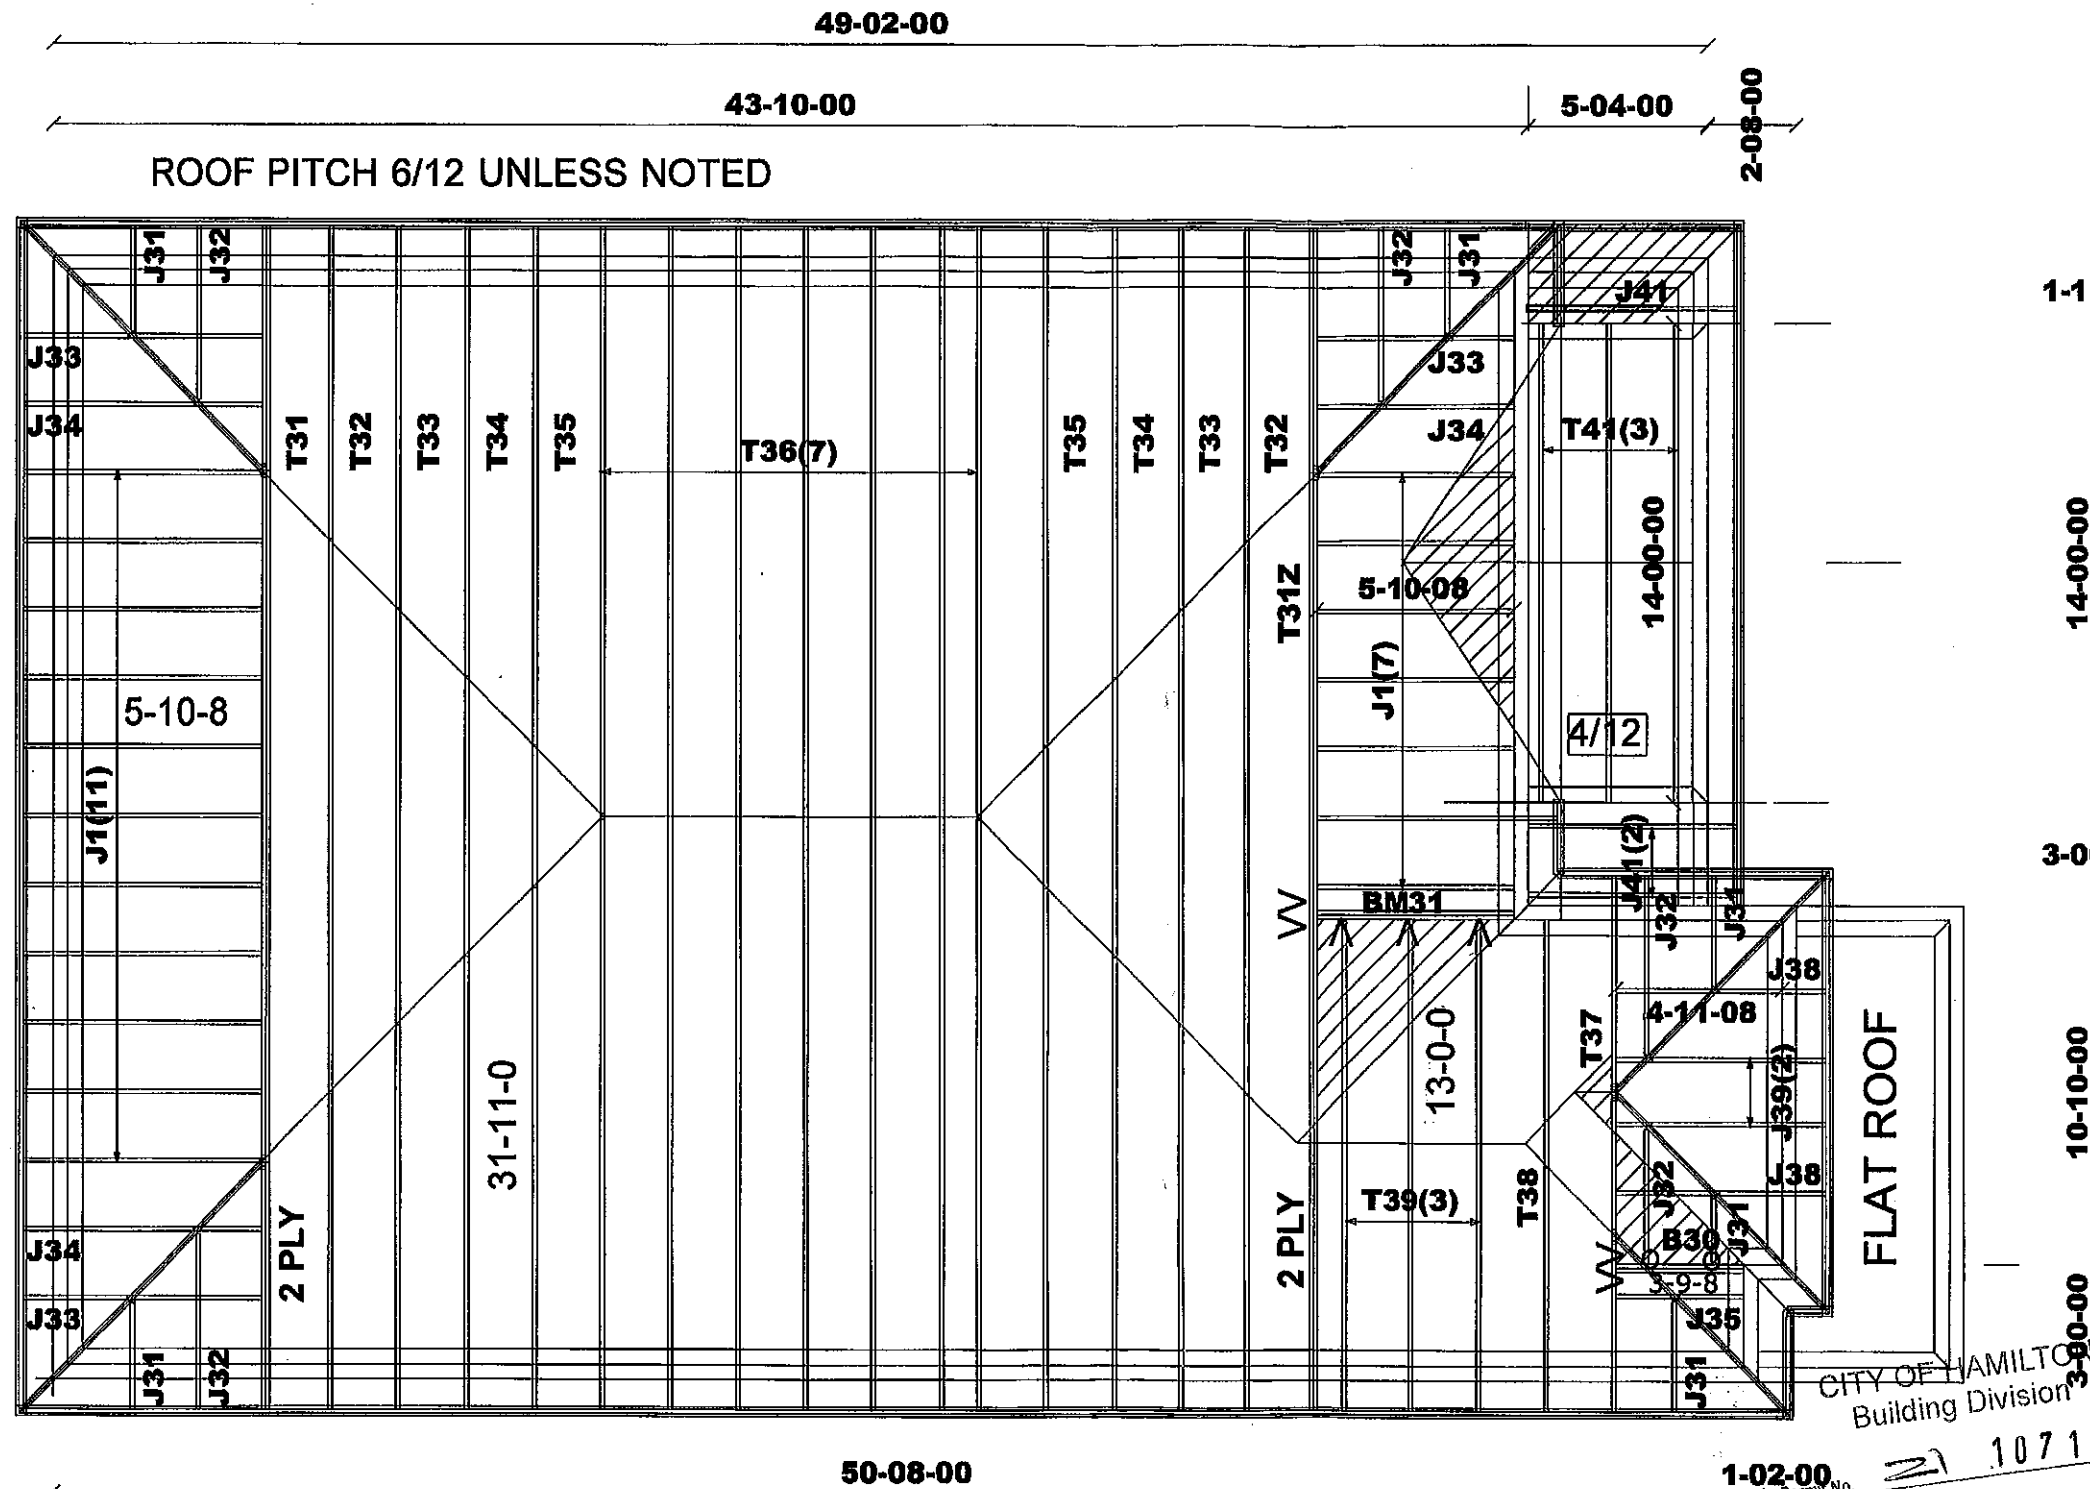

50-08-00

ASPHALT SHINGLES
12" FINISHED OH.
R.T.M.C.
2X6 EXTERIOR WALLS
2X6 FASCIA BOARD

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
LUS26-2 - (VV)

DENOTES
CONV.
FRAMING

DESIGN CONFORMS
WITH O.B.C.2012 PART 9
(2019 AMENDMENT)
DESIGN LOADS:
SNOW LOAD 25.6 PSF
TC DEAD 6 PSF
BC LIVE 0 PSF
BC DEAD 7.4 PSF

BM30, BM31 = 2-2X10

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications have been reviewed by
FEB 23 2021
DATE
FOR CHIEF BUILDING OFFICIAL

M13109



Job Track: 51225
Plan Log: 202403
Layout ID: 408159

Builder / Location:
GREEN PARK HOMES / WATERDOWN
Project: RUSSELL GARDENS PH.3
Date: 2020-04-17 Sales: Mario DiDano Designer: AC/JG

Model / Elevation:
VALLEYCREEK 3/3





THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR
REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY
TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

Model ver 8.3.1.215

LOT 308

 TAMARACK ROOF TRUSSES INC. ALPHA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: VALLEYCREEK 3 Lot #: 308 Elevation: 3	Job Track: 51225 PlanLog: 202403 Layout ID: 408159 Ref # Page: 1 of 2 Date: 04-15-2020 Designer: Andrew Conway Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T31 Hip Girder	6 /12	31-11-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	285.1 176.00		
	1 2-ply	T312 Hip Girder	6 /12	31-11-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	285.1 176.00		
	2	T32 Hip	6 /12	31-11-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	259.03 161.67		
	2	T33 Hip	6 /12	31-11-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	258.25 161.33		
	2	T34 Hip	6 /12	31-11-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	271.21 168.33		
	2	T35 Hip	6 /12	31-11-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	262.67 165.00		
	7	T36 Hip	6 /12	31-11-00	9-01-12	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	904.65 565.83		
	1	T37 Roof Special Girder	6 /12	13-00-00	3-08-00	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	62.12 40.50		
	1	T38 Hip	6 /12	13-00-00	4-00-12	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	54.06 35.33		
	3	T39 Common	6 /12	13-00-00	4-05-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	155.89 98.00		
	3	T41 Common	4 /12	14-00-00	2-09-08	2 x 4		5-08 5-08	110.38 68.50		
	18	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	302.3 192.00		
	6	J31 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	42.13 28.00		
	5	J32 Jack-Open	6 /12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	47.85 30.00		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: VALLEYCREEK 3
 Lot #: 308
 Elevation: 3

Job Track: 51225
 PlanLog: 202403
 Layout ID: 408159
 Ref #
 Page: 2 of 2
 Date: 04-15-2020
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	3	J33 Jack-Open	6/12	5-10-08	2-00-12	2 x 4	1-03-08	1-02-00 4-01-04	34.75 22.00		
	3	J34 Jack-Open	6/12	5-10-08	3-00-12	2 x 4	1-03-08	1-02-00 4-01-04	42.4 26.00		
	1	J35 Jack-Open	6/12	3-09-08	2-01-08	2 x 4		1-02-00 3-00-12	7.72 5.33		
	2	J38 Jack-Open	6/12	1-10-15	2-01-08	2 x 4	1-03-08 3-00-09	1-02-00 2-01-08	21.39 13.33		
	2	J39 Jack-Open	6/12	3-10-15	3-01-08	2 x 4	1-03-08 1-00-09	1-02-00 3-01-08	26.49 16.00		
	3	J41 Jack-Open	6/12	5-08-08	3-09-15	2 x 4	1-03-08	4-03 2-09-11	48.8 30.00		

TOTAL # TRUSS= 70

TOTAL BFT OF ALL TRUSSES= 2177.15 BFT.

TOTAL WEIGHT OF ALL TRSSES 3482.19 LBS


HARDWARE

QTY	TYPE	MODEL	LENGTH
3	Hardware	LJS26DS	
2	Hardware	LUS24	
2	Hardware	LUS26-2	


TOTAL NUMBER OF
ITEMS= 7

JOB NAME 408157	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Wed Apr 15 12:13:24 2020 Page 1
ID:7R4Dn_C9iAuIONuKpIv7nzzlwO4-ZAyfhQa1x998vyscuuXFRGsa_lqREu6rA8mugdzQUhP
1-3-8 0-0 3-0-12 3-5-5 6-3-11 9-9-1 6-2-7 15-11-8 6-2-7 22-1-15 6-3-11 28-5-11 31-1-10 33-2-8
1-3-8 0-0 3-4-5 6-3-11 9-9-1 6-2-7 16-11-8 6-2-7 22-1-15 6-3-11 28-5-11 30-10-4 31-11-0 1-3-8
Scale = 1:52.8

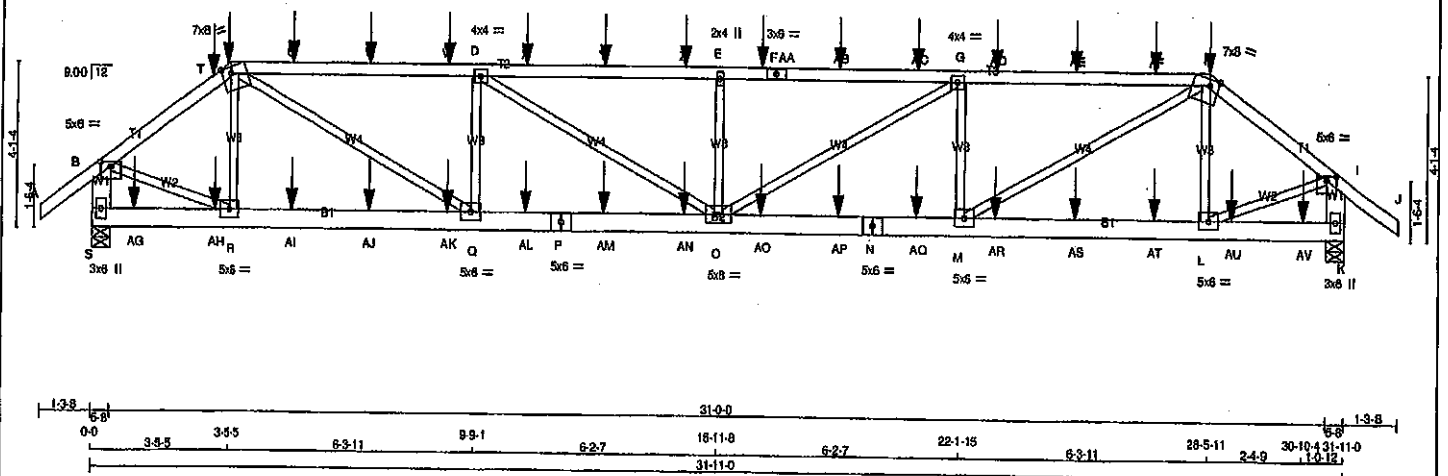

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESOR. A - C 2x4 DRY No.2 SPF C - F 2x4 DRY 2100F 1.8E SPF F - H 2x4 DRY 2100F 1.8E SPF H - J 2x4 DRY No.2 SPF S - B 2x6 DRY No.2 SPF K - I 2x6 DRY No.2 SPF S - P 2x6 DRY No.2 SPF P - N 2x6 DRY No.2 SPF N - K 2x6 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT DRY: SEASONED LUMBER. DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS: CHORDS #ROWS SURFACE SPACING (IN) LOAD(PLF) TOP CHORDS : (0.122"x3") SPIRAL NAILS A-C 1 12 SIDE(61.0) C-F 1 12 SIDE(65.9) F-H 1 12 SIDE(65.9) H-J 1 12 SIDE(61.0) S-B 2 12 TOP K-I 2 12 TOP BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS S-P 2 12 SIDE(0.0) P-N 2 12 SIDE(0.0) N-K 2 12 SIDE(0.0) WEBS : (0.122"x3") SPIRAL NAILS 2x3 1 6 NAILS TO BE DRIVEN FROM ONE SIDE ONLY. GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS. TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY. SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP. PLATES (table is in inches) JT TYPE PLATES W LEN Y X B TTMVW-p MT20 5.0 6.0 1.25 3.00 C TTMVW-m MT20 7.0 8.0 Edge 3.00 D TTMVW-l MT20 4.0 4.0 E TTMVW-w MT20 2.0 4.0 F TS-l MT20 3.0 6.0 G TTMVW-l MT20 4.0 4.0 H TTMVW-m MT20 7.0 8.0 Edge 3.00 I TTMVW-p MT20 5.0 6.0 1.25 3.00 K BMV1+p MT20 3.0 6.0 L, M, Q, R L BMVW-l MT20 5.0 6.0 N BS-l MT20 5.0 6.0 O BMVWV-l MT20 5.0 8.0 P BS-l MT20 5.0 8.0 S BMV1+p MT20 3.0 6.0 Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED GROSS REACTION MAXIMUM FACTORED GROSS REACTION INPUT REQD DOWN HORZ UPLIFT IN-SX BRG IN-SX BRG JT 3148 0 3148 0 0 5-8 5-8 S 3148 0 3148 0 0 5-8 5-8 K 3047 0 3047 0 0 5-8 5-8 UNFACTORED REACTIONS 1ST LCASE MAX/MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL S 2224 1474 / 0 0 / 0 0 / 0 750 / 0 0 / 0 K 2155 1417 / 0 0 / 0 0 / 0 738 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.35 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD (PLF) MAX. UNBRACED LENGTH (LBS) WEBS MAX. FACTORED FORCE (LBS) MAX. CSI (LC) FR-TO FROM TO A-B 0 / 38 -91.8 -91.8 0.07 (1) 10.00 R-C -619 / 0 0.08 (1) B-T -3285 / 0 -91.8 -91.8 0.17 (1) 4.98 C-Q 0 / 3382 0.42 (1) T-C -3285 / 0 -91.8 -91.8 0.17 (1) 4.98 Q-D -1598 / 0 0.20 (1) C-U -5545 / 0 -91.8 -91.8 0.40 (1) 4.63 D-O 0 / 983 0.12 (1) U-V -5545 / 0 -91.8 -91.8 0.40 (1) 4.63 O-E -841 / 0 0.11 (1) V-W -5545 / 0 -91.8 -91.8 0.40 (1) 4.63 O-G 0 / 1028 0.13 (1) W-D -5545 / 0 -91.8 -91.8 0.40 (1) 4.63 M-G -1562 / 0 0.20 (1) D-X -6388 / 0 -91.8 -91.8 0.43 (1) 4.35 M-H 0 / 3429 0.42 (1) X-Y -6388 / 0 -91.8 -91.8 0.43 (1) 4.35 L-H -590 / 0 0.07 (1) Y-Z -6388 / 0 -91.8 -91.8 0.43 (1) 4.35 B-R 0 / 2774 0.34 (1) Z-E -6388 / 0 -91.8 -91.8 0.43 (1) 4.35 L-I 0 / 2690 0.33 (1) E-AA -6388 / 0 -91.8 -91.8 0.43 (1) 4.35 AA-F -6388 / 0 -91.8 -91.8 0.43 (1) 4.35 F-AB -6388 / 0 -91.8 -91.8 0.43 (1) 4.35 AB-AC -6388 / 0 -91.8 -91.8 0.43 (1) 4.35 AC-G -6388 / 0 -91.8 -91.8 0.43 (1) 4.35 G-AD -5506 / 0 -91.8 -91.8 0.40 (1) 4.64 AD-AE -5506 / 0 -91.8 -91.8 0.40 (1) 4.64 AE-AF -5506 / 0 -91.8 -91.8 0.40 (1) 4.64 AF-H -5506 / 0 -91.8 -91.8 0.40 (1) 4.64 H-I -3217 / 0 -91.8 -91.8 0.16 (1) 5.05 I-J 0 / 38 -91.8 -91.8 0.07 (1) 10.00 S-B -3127 / 0 0.0 0.0 0.11 (1) 7.80 K-I -3026 / 0 0.0 0.0 0.11 (1) 7.81 S-AG 0 / 0 -18.5 -18.5 0.08 (4) 10.00 AG-AH 0 / 0 -18.5 -18.5 0.08 (4) 10.00 AH-R 0 / 0 -18.5 -18.5 0.08 (4) 10.00 RA-AI 0 / 2830 -18.5 -18.5 0.21 (1) 10.00 AI-AJ 0 / 2830 -18.5 -18.5 0.21 (1) 10.00 AJ-AK 0 / 2830 -18.5 -18.5 0.21 (1) 10.00 AK-Q 0 / 2830 -18.5 -18.5 0.21 (1) 10.00 Q-AL 0 / 5545 -18.5 -18.5 0.42 (1) 10.00 AL-P 0 / 5545 -18.5 -18.5 0.42 (1) 10.00 P-AM 0 / 5545 -18.5 -18.5 0.42 (1) 10.00 AM-AN 0 / 5545 -18.5 -18.5 0.42 (1) 10.00 AN-O 0 / 5545 -18.5 -18.5 0.42 (1) 10.00 O-AO 0 / 5506 -18.5 -18.5 0.42 (1) 10.00 AO-AP 0 / 5506 -18.5 -18.5 0.42 (1) 10.00 AP-N 0 / 5506 -18.5 -18.5 0.42 (1) 10.00 N-AQ 0 / 5506 -18.5 -18.5 0.42 (1) 10.00 AQ-M 0 / 5506 -18.5 -18.5 0.42 (1) 10.00 MAR 0 / 2550 -18.5 -18.5 0.21 (1) 10.00				DESIGN CRITERIA *** SPECIAL LOADS ANALYSIS *** GEOMETRY AND/OR BASIC LOADS CHANGED BY USER. LOADS WERE DERIVED FROM USER INPUT NO FURTHER MODIFICATIONS WERE MADE SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM *** NON STANDARD GIRDER *** ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES. THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2018, CBC 2012, ABC 2019 - PART 9 OF CBC 2012 (2019 AMENDMENT) - CSA 088-09, CSA 088-14 - TPIC 2011, TPIC 2014 (55% OF 31.1 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL) = L/360 (1.08") CALCULATED VERT. DEFL.(LL) = L/999 (0.16") ALLOWABLE DEFL.(TL) = L/360 (1.08") CALCULATED VERT. DEFL.(TL) = L/999 (0.28") CSI: TC=0.43/1.00 (E-G:1), BC=0.42/1.00 (O-Q:1), WB=0.42/1.00 (H-M:1), SS=0.25/1.00 (C-D:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00 COMPANION LIVE LOAD FACTOR = 1.00 AUTOSOLVE HEELS OFF TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1887 768 1987 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP = 0.83 (O) (INPUT = 0.90) JSI METAL = 0.54 (N) (INPUT = 1.00) Structural component only 1/2 DWG# T-2006181			
---	--	--	--	---	--	--	--	---	--	--	--

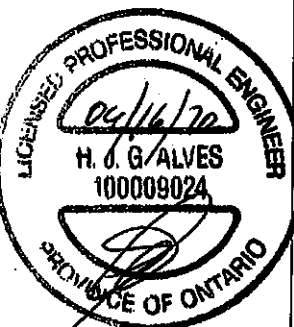

LOADING

TOTAL LOAD CASES: (4)

CHORDS

MEMB.

MAX. FACTORED FORCE (LBS)

FACTORED VERT. LOAD (PLF)

LC1

MAX

MAX. GSI (LC)

UNBRAC LENGTH

MEMB.

MAX. FACTORED FORCE (LBS)

FACTORED VERT. LOAD (PLF)

LC1

MAX

MAX. GSI (LC)

UNBRAC LENGTH

FR-TO

AR-AS

AS-AT

AT-L

L-AU

AU-AV

AV-K

0 / 2550

0 / 2550

0 / 2550

0 / 0

0 / 0

0 / 0

-18.5

-18.5

-18.5

-18.5

-18.5

-18.5

-18.5

-18.5

-18.5

-18.5

-18.5

-18.5

0.21 (1)

0.21 (1)

0.21 (1)

0.06 (4)

0.06 (4)

0.06 (4)

10.00

10.00

10.00

10.00

10.00

10.00

FACTORED CONCENTRATED LOADS (LBS)

LOC.

LC1

MAX-

MAX+

FACE

DIR.

TYPE

HEEL

CONN.

JT

C

C

H

H

T

U

V

W

X

Y

Z

AA

AB

AC

AD

AE

AF

AG

AH

AI

AJ

AK

AL

AM

AN

AO

AP

AQ

AR

AS

AT

AU

AV

3-5-5

3-5-5

28-5-11

28-5-11

3-0-12

5-0-12

7-0-12

9-0-12

11-0-12

13-0-12

15-0-12

17-0-12

19-0-12

21-0-12

23-0-12

25-0-12

27-0-12

1-0-12

3-0-12

5-0-12

7-0-12

9-0-12

11-0-12

13-0-12

15-0-12

17-0-12

19-0-12

21-0-12

23-0-12

25-0-12

27-0-12

29-0-12

30-10-4

-44

-225

-44

-225

-110

-110

-110

-110

-110

-110

-110

-110

-110

-110

-110

-110

-26

-26

-26

-26

-26

-26

-26

-26

-26

-26

-26

-26

-26

-26

-26

-26

-49

-225

-49

-225

-139

-110

-110

-110

-110

-110

-110

-110

-110

-110

-110

-110

-26

-26

-26

-26

-26

-26

-26

-26

-26

-26

-26

-26

-26

-26

-26

-26

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

FRONT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

VERT

DEAD

SNOW

DEAD

SNOW

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

TOTAL

--

--

--

--

--

--

--

--

--

--

--

--

--

--

--

--

--

--

--

--

--

--

--

--

--

--

--

--

--

--

--

--

C1

C1

C1

C1

C1

C1

C1

C1

C1

C1

C1

C1

C1

C1

C1

C1

C1

C1

C1

C1

C1

C1

C1

C1

C1

C1

C1

C1

C1


C1

C1

C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

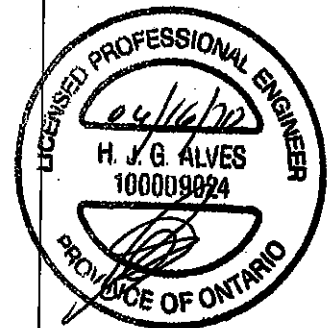

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408157	T1Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington


Version 8.310 6 Oct 29 2019 MITek Industries, Inc. Wed Apr 15 12:13:26 2020 Page 2
ID:7R4Dg C9IAuIONuKpLv?nzzlwO4-1NW1umbfITH7X6RoSc2U TPKY97UzK3 PpWSD3zCQhQ

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
H	28-5-11	-44	-49	---	FRONT	VERT	DEAD	---	C1
H	28-5-11	-225	-225	---	FRONT	VERT	SNOW	---	C1
T	18-10-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	18-10-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	20-10-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	22-10-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
X	24-10-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
Y	26-10-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
Z	28-10-4	-139	-139	---	BACK	VERT	TOTAL	---	C1
AA	1-0-12	-28	-28	---	BACK	VERT	TOTAL	---	C1
AB	1-9-8	-1200	-1200	---	BACK	VERT	TOTAL	---	C1
AC	15-2-8	-1200	-1200	---	BACK	VERT	TOTAL	---	C1
AD	18-10-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
AE	18-10-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AF	20-10-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AG	22-10-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AH	24-10-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AI	26-10-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AJ	28-10-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AK	30-10-4	-26	-26	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

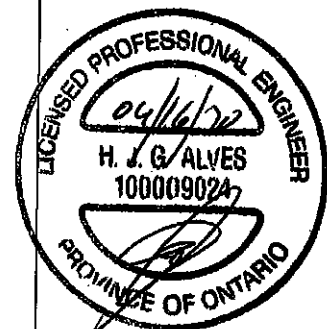


Structural component only
DWG# T-2006182

42

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408158	T1Z1	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 20 2019 Mitek Industries, Inc. Mon Apr 20 14:09:18 2020 Page 1
ID:7R4Dg_C9IAuONuKplv?nzzlwO4-CK8d4LnC7AUzQTmgEfd6IMwKUZXXR8Yk1QcJ7IzOpWn
20-10-4 22-1-15 28-5-11 28-10-4 31-11-0 33-2-8
Scale = 1:52.6

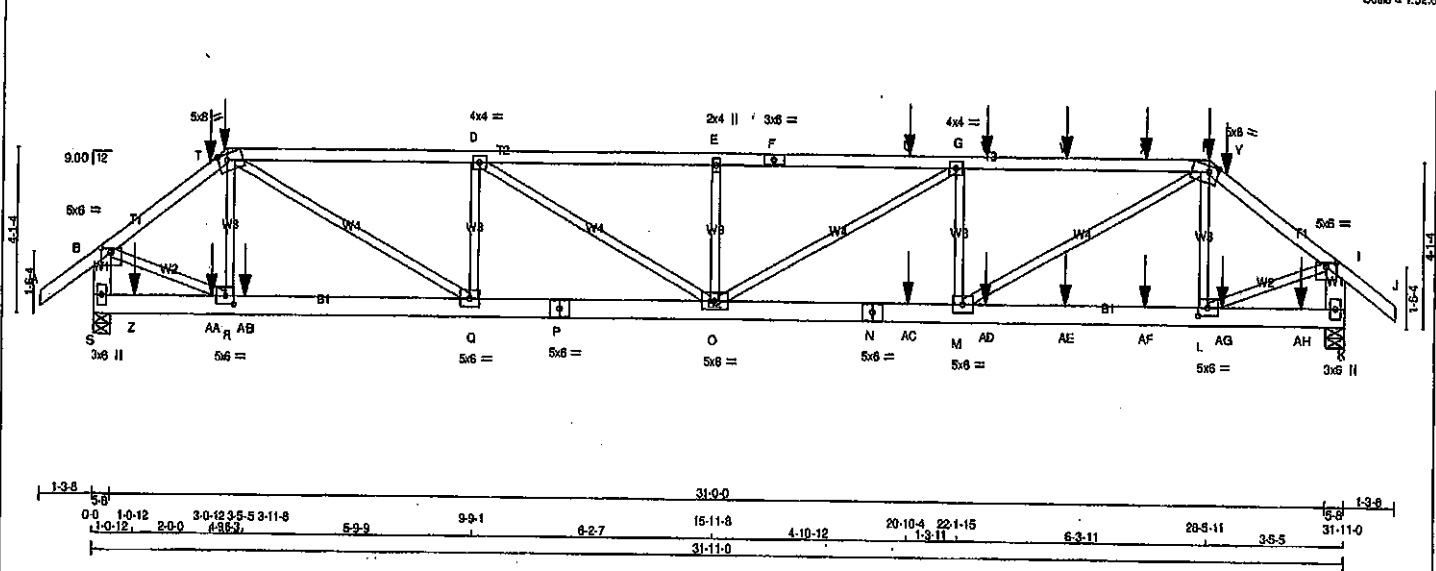

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	1650F 1.5E
C - F	2x4	DRY	1650F 1.5E
F - H	2x4	DRY	1650F 1.5E
H - J	2x4	DRY	1650F 1.5E
S - B	2x6	DRY	No.2
K - I	2x6	DRY	No.2
S - P	2x6	DRY	No.2
P - N	2x6	DRY	No.2
N - K	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C	12	SIDE(61.0)
C-F	12	SIDE(61.0)
F-H	12	SIDE(61.0)
H-J	12	SIDE(61.0)
S-B	2	TOP
K-I	2	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
S-P	2	TOP
P-N	2	TOP
N-K	2	TOP
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	6	SIDE(0.0)

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0	8.0 1.25 3.00
C	TTWV-m	MT20	5.0	8.0 1.75 3.00
D	TMVW-i	MT20	4.0	4.0
E	TMVW-w	MT20	2.0	4.0
F	TS-i	MT20	3.0	8.0
G	TMVW-i	MT20	4.0	4.0
H	TTWV-m	MT20	5.0	8.0 1.75 3.00
I	TMVW-p	MT20	5.0	8.0 1.25 3.00
K	BMV1+p	MT20	3.0	8.0
L	BMVW-i	MT20	5.0	8.0 2.50 2.75
M	BMVW-i	MT20	5.0	8.0
N	BS-i	MT20	5.0	8.0
O	BMVWV-i	MT20	5.0	8.0
P	BS-i	MT20	5.0	8.0
Q	BMVW-i	MT20	5.0	8.0
R	BMVW-i	MT20	5.0	8.0 2.50 2.75
S	BMV1+p	MT20	3.0	8.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG
S	3610 0	3610 0	5-8
K	2915 0	2915 0	5-8

UNFACTORED REACTIONS			
JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	
S	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL	
S	2545	1716 / 0 0 / 0 0 / 0 0 / 0 828 / 0 0 / 0	
K	2057	1375 / 0 0 / 0 0 / 0 0 / 0 682 / 0 0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO			
A-B	0 / 38	-91.8 -91.8 0.06 (1)	10.00
B-T	-3685 / 0	-91.8 -91.8 0.13 (1)	5.27
T-C	-3685 / 0	-91.8 -91.8 0.13 (1)	5.27
C-D	-5005 / 0	-91.8 -91.8 0.33 (1)	4.80
D-E	-5469 / 0	-91.8 -91.8 0.35 (1)	4.43
E-F	-5469 / 0	-91.8 -91.8 0.49 (1)	4.25
F-U	-5469 / 0	-91.8 -91.8 0.49 (1)	4.25
U-G	-5469 / 0	-91.8 -91.8 0.47 (1)	4.44
G-V	-4922 / 0	-91.8 -91.8 0.47 (1)	4.44
V-W	-4922 / 0	-91.8 -91.8 0.47 (1)	4.44
W-X	-4922 / 0	-91.8 -91.8 0.12 (1)	5.81
X-H	-4922 / 0	-91.8 -91.8 0.12 (1)	5.81
H-Y	-3010 / 0	-91.8 -91.8 0.08 (1)	10.00
Y-I	-3010 / 0	-91.8 -91.8 0.12 (1)	5.81
I-J	0 / 38	-91.8 -91.8 0.06 (1)	10.00
S-B	-3839 / 0	0.0 0.0 0.13 (1)	7.37
K-I	-2893 / 0	0.0 0.0 0.10 (1)	7.61

WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO			
R-C	0 / 467	0.06 (1)	10.00
C-Q	0 / 2165	0.27 (1)	10.00
Q-D	-921 / 0	0.12 (1)	10.00
D-O	0 / 541	0.07 (1)	10.00
O-E	-512 / 0	0.08 (1)	10.00
E-G	0 / 837	0.06 (1)	10.00
G-M	-1308 / 0	0.17 (1)	10.00
M-H	0 / 2912	0.38 (1)	10.00
H-L	-550 / 0	0.07 (1)	10.00
L-R	0 / 3276	0.41 (1)	10.00
R-I	0 / 2544	0.31 (1)	10.00

FACTORED CONCENTRATED LOADS (LBS)			
JT	LOC.	LC1	MAX. MAX.
C	3-5-5	-44	-49
C	3-5-5	-225	-225
H	28-5-11	-44	-49
H	28-5-11	-225	-225
T	3-0-12	-139	-139

TOTAL WEIGHT = 2 X 145 = 289 lb

DESIGN CRITERIA
*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 PL/G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCS 2010, NBCS 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCS 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")
CALCULATED VERT. DEFL.(LL) = L/899 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (1.08")
CALCULATED VERT. DEFL.(TL) = L/899 (0.27")

CSI: TC=0.49/1.00 (E-G:1), BC=0.37/1.00 (M-O:1), WB=0.41/1.00 (B-R:1), SSI=0.43/1.00 (Q-R:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES			
PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MIN MAX MIN MAX
MT20	618 354	1667 788	1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.80 (H) (INPUT = 0.90)
JSI METAL=0.48 (H) (INPUT = 1.00)

Structural component only
DWG# T-2006618
CONTINUED ON PAGE 2

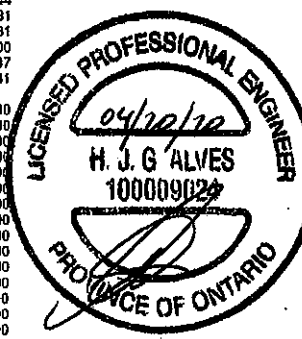

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408158	T1Z1	1	2	TRUSS DESC.		


Tamarack Roof Truss, Burlington
 Version 8.310 S Oct 28 2019 Mitex Industries, Inc. Mon Apr 20 14:09:18 2020 Page 2

ID:7R4Dg C9IAuIQNuKpIv?nzzlwO4-CK8d4LnC7AUzQTmgEfd6tMwKUzXXR8Yk1QcJ7IzOpWm

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
U	20-10-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	22-10-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	24-10-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
X	26-10-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
Y	28-10-4	-139	-139	---	BACK	VERT	TOTAL	---	C1
Z	1-0-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AA	3-0-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AB	3-11-8	-1285	-1285	---	BACK	VERT	TOTAL	---	C1
AC	20-10-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AD	22-10-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AE	24-10-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AF	26-10-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AG	28-10-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AH	30-10-4	-26	-26	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

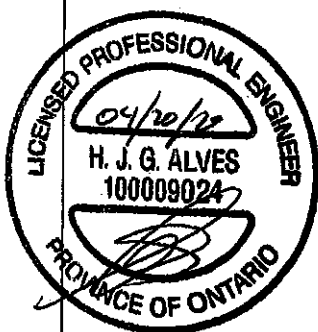

Structural component only
 DWG# T-2006618

JOB NAME 408157	TRUSS NAME T2	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Wed Apr 15 12:13:26 2020 Page 1
 ID:7R4Dg_C9iAuiONuKplv?nzzlwO4-WZ4P86cHTnPs8G0_OJZVhxtIGZV4ipn7eTF?IWzQUhN
 13-8 0.0 4-9.5 4-9.5 5-7-11 10-5-1 5-6-7 15-11-8 5-6-7 21-5-15 5-7-11 27-1-11 4-9-5 31-11-0 13-8
 Scale = 1:52.6

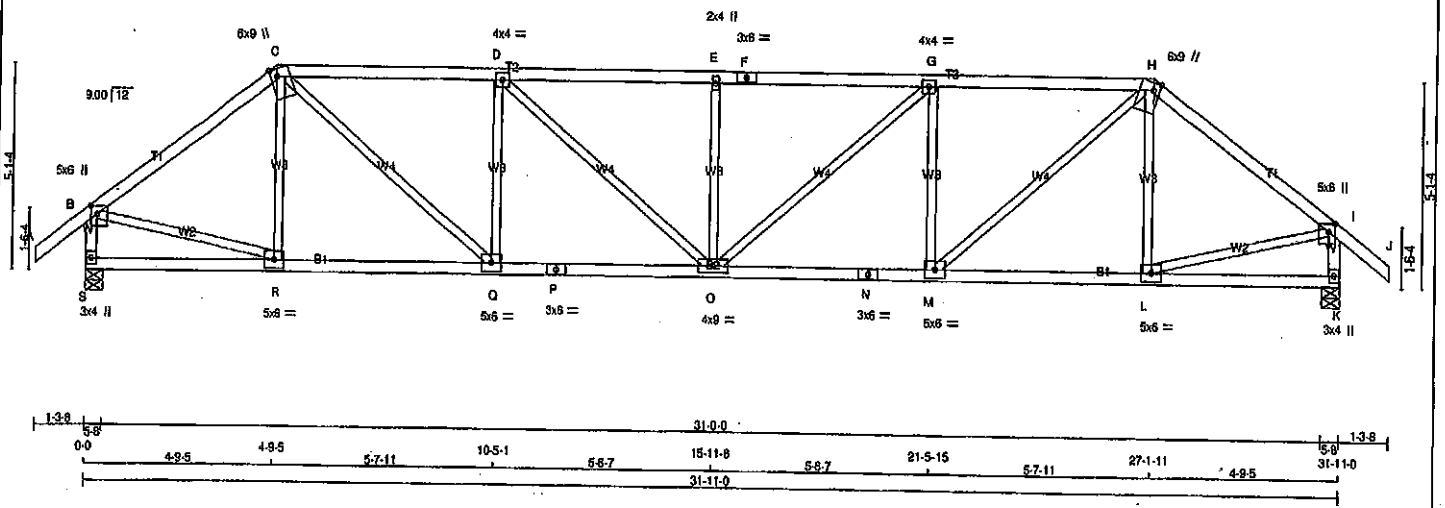

LUMBER	N. L. G. A. RULES	SIZE	LUMBER
CHORDS			
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
S - P	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)	W	LEN	Y	X
JT TYPE				
B TMVW+p	MT20	5.0	8.0	2.50 2.00
C TTWW+m	MT20	6.0	9.0	Edge 2.00
D TMWW-t	MT20	4.0	4.0	
E TMW+w	MT20	2.0	4.0	
F TS-t	MT20	3.0	6.0	
G TMWW-t	MT20	4.0	4.0	
H TTWW+m	MT20	6.0	9.0	Edge 2.00
I TMVW+p	MT20	5.0	8.0	2.50 2.00
K BMVt+p	MT20	3.0	4.0	
L, M, Q, R				
L BMWW-t	MT20	5.0	8.0	
N BS-t	MT20	3.0	6.0	
O BMWW-t	MT20	4.0	9.0	
P BS-t	MT20	3.0	6.0	
S BMVt+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	IN-SX
S	1888	0	0	1888	0	0	0	5-8	5-8
K	1888	0	0	1888	0	0	0	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX/MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
S	1331	887 / 0	0 / 0	0 / 0	0 / 0
K	1331	887 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K
BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.48 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)	
CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0 / 38	A-B	0 / 38
B-C	-1888 / 0	B-C	-259 / 0
C-D	-2634 / 0	C-D	0 / 1485
D-E	-2634 / 0	D-E	-861 / 0
E-F	-2634 / 0	E-F	0 / 434
F-G	-2634 / 0	F-G	-861 / 0
G-H	-2634 / 0	G-H	0 / 434
H-I	-1888 / 0	H-I	-861 / 0
I-J	0 / 38	I-J	0 / 1485
J-K	-1851 / 0	J-K	-259 / 0
K-L	-1851 / 0	K-L	0 / 1552
L-M	0 / 0	L-M	0 / 1552
M-N	-18.5	M-N	0.36 (1)
N-O	-18.5	N-O	0.36 (1)
O-P	-18.5	O-P	0.36 (1)
P-Q	-18.5	P-Q	0.36 (1)
Q-R	-18.5	Q-R	0.36 (1)
R-S	-18.5	R-S	0.36 (1)
S-T	-18.5	S-T	0.36 (1)
T-U	-18.5	T-U	0.36 (1)
U-V	-18.5	U-V	0.36 (1)
V-W	-18.5	V-W	0.36 (1)
W-X	-18.5	W-X	0.36 (1)
X-Y	-18.5	X-Y	0.36 (1)
Y-Z	-18.5	Y-Z	0.36 (1)
Z-A	-18.5	Z-A	0.36 (1)

TOTAL WEIGHT = 2 X 131 = 262 lb

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH.	LL = 25.6 PSF
BOT CH.	LL = 6.0 PSF
TOTAL LOAD	= 39.0 PSF
SPACING	= 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM
 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
 ALLOWABLE DEFL.(TL) = L/360 (1.06")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.27")
 CSI: TC=0.63/1.00 (D-E:1), BC=0.47/1.00 (M-O:1), WB=0.35/1.00 (I-L:1), SS=0.24/1.00 (C-D:1)


DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10
 COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	
PLATE GRIP(DRY)	SHEAR SECTION
(PSI)	(PLI)
MT20	618 354 1687 788 1987 1658


PLATE PLACEMENT TOL. = 0.250 inches
 PLATE ROTATION TOL. = 5.0 Deg.

ISI GRIP= 0.80 (I) (INPUT = 0.80)
 SI METAL= 0.80 (P) (INPUT = 1.00)

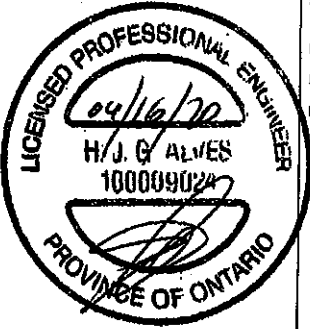

JOB NAME 408157	TRUSS NAME T3	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 20 2019 Mittek Industries, Inc. Wed Apr 15 12:13:27 2020 Page 1
 ID:7R4Dg_C9iAu10NuKpiv7nzzlwO4-JenJRovD4YjmQaBa04y3uU7tyraR9EHs77YHyZQUhM
 13-8 0.0 3-1-15 3-1-15 2-11-7 6-1-5 6-7-3 12-8-8 6-5-15 19-2-8 6-7-3 25-9-11 2-11-7 28-9-1 31-11-0 31-11-0 13-8
 Scale = 1:52.8

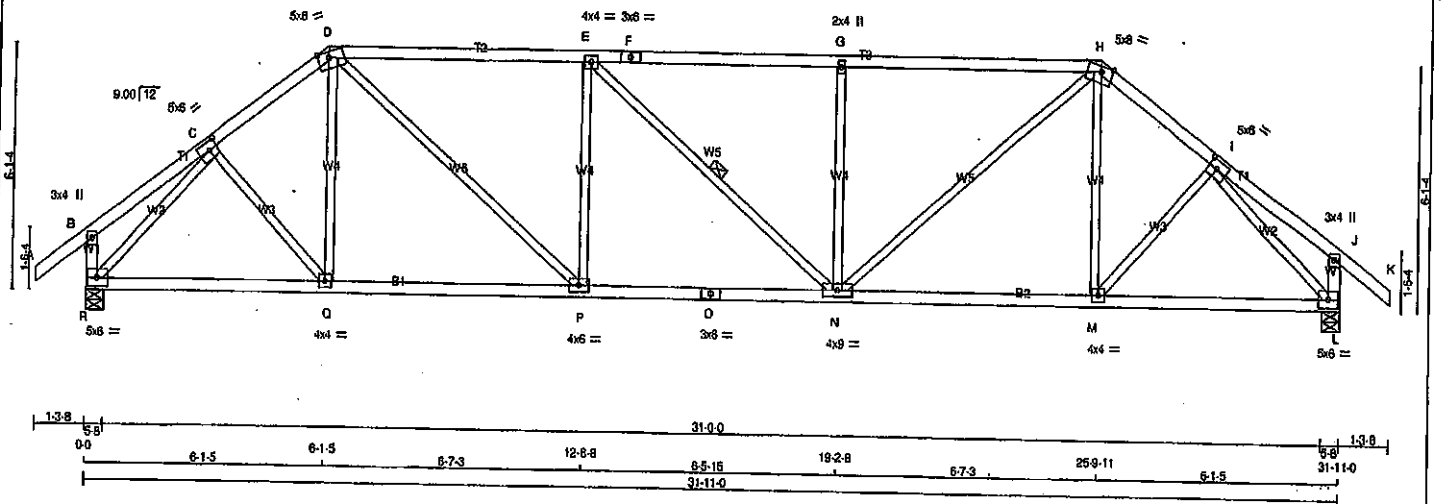

LUMBER
 N. L. G. A. RULES
 CHORDS SIZE LUMBER
 A - D 2x4 DRY No.2
 D - F 2x4 DRY No.2
 F - H 2x4 DRY No.2
 H - K 2x4 DRY No.2
 R - B 2x4 DRY No.2
 L - J 2x4 DRY No.2
 R - O 2x4 DRY No.2
 O - L 2x4 DRY No.2
 ALL WEBS 2x3 DRY No.2
 EXCEPT
 DRY: SEASONED LUMBER.

DESIGN CRITERIA		TOTAL WEIGHT = 2 X 135 = 271 lb	
SPECIFIED LOADS:			
TOP CH.	LL = 25.6 PSF		
	DL = 6.0 PSF		
BOT CH.	LL = 0.0 PSF		
	DL = 7.4 PSF		
TOTAL LOAD	= 39.0 PSF		
SPACING = 24.0 IN. C/C			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER		TOTAL WEIGHT = 2 X 135 = 271 lb	
BEARINGS			
	FACTORED	MAXIMUM FACTORED	INPUT
	GROSS REACTION	GROSS REACTION	BRG
JT	VERT	DOWN	UPLIFT
R	1886 0	1886 0	0 5-8
L	1886 0	1886 0	0 5-8

UNFACTORED REACTIONS		TOTAL WEIGHT = 2 X 135 = 271 lb	
1ST LCASE	MAX/MIN. COMPONENT REACTIONS		
JT	COMBINED	SNOW	LIVE
R	1331 887 / 0	0 / 0	0 / 0
L	1331 887 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L
BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.63 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.
 1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.
 END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
 TOTAL LOAD CASES: (4)
 CHORDS
 MAX. FACTORED
 MEMB. FORCE (LBS)


MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	LC1	MAX	MAX	UNBRAC	MEMB.	FORCE (LBS)	MAX	MAX
FR-TO		FROM TO					FR-TO			
A-B	0 / 38	-91.8	-91.8	0.12 (1)	10.00		C-Q	0 / 167	0.04 (1)	
B-C	0 / 16	-91.8	-91.8	0.11 (1)	10.00		Q-D	0 / 77	0.03 (4)	
C-D	-1914 / 0	-91.8	-91.8	0.16 (1)	4.73		D-P	0 / 1169	0.26 (1)	
D-E	-2390 / 0	-91.8	-91.8	0.77 (1)	3.63		P-E	-652 / 0	0.38 (1)	
E-F	-2389 / 0	-91.8	-91.8	0.78 (1)	3.63		E-N	-2 / 0	0.00 (1)	
F-G	-2389 / 0	-91.8	-91.8	0.78 (1)	3.63		N-G	-651 / 0	0.38 (1)	
G-H	-2389 / 0	-91.8	-91.8	0.78 (1)	3.63		H-H	0 / 1164	0.26 (1)	
H-I	-1914 / 0	-91.8	-91.8	0.16 (1)	4.73		M-H	0 / 78	0.03 (4)	
I-J	0 / 16	-91.8	-91.8	0.11 (1)	10.00		M-I	0 / 167	0.04 (1)	
J-K	0 / 38	-91.8	-91.8	0.12 (1)	10.00		R-C	-2127 / 0	0.72 (1)	
R-B	-239 / 0	0.0	0.0	0.02 (1)	7.81		I-L	-2128 / 0	0.72 (1)	
L-J	-239 / 0	0.0	0.0	0.02 (1)	7.81					

MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	LC1	MAX	MAX	UNBRAC	MEMB.	FORCE (LBS)	MAX	MAX
FR-TO		FROM TO					FR-TO			
R-Q	0 / 1401	-18.5	-18.5	0.32 (1)	10.00					
Q-P	0 / 1614	-18.5	-18.5	0.34 (1)	10.00					
P-O	0 / 2391	-18.5	-18.5	0.46 (1)	10.00					
O-N	0 / 2391	-18.5	-18.5	0.46 (1)	10.00					
N-M	0 / 1614	-18.5	-18.5	0.34 (1)	10.00					
M-L	0 / 1401	-18.5	-18.5	0.33 (1)	10.00					

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.
 CS: TC=0.77/1.00 (D-E:1), BC=0.46/1.00 (N-P:1),
 WB=0.72/1.00 (H-I:1), SS=0.29/1.00 (D-E:1)
 DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10
 COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1867 788 1987 1856
 PLATE PLACEMENT TOL. = 0.250 inches
 PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.88 (I) (INPUT = 0.80)
 JSI METAL= 0.79 (O) (INPUT = 1.00)

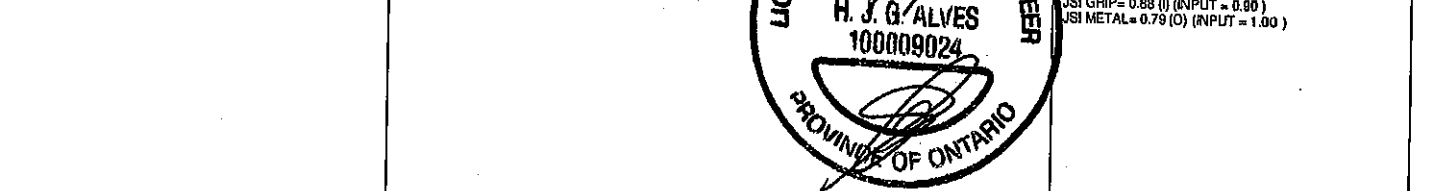

Structural component only
 DWG# T-2006184

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408157	T4	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Wed Apr 15 12:13:28 2020 Page 1
 ID:7R4Dg_C91AulONuKplv?nzzlwO4-SyBAWndX_OgaOZ9N7kbBc61EcMBxAcGQ5mk6pOzQUhL
 13-8 0-0 3-9-15 3-9-15 3-7-7 7-5-5 5-8-8 13-1-14 5-7-4 18-9-2 5-8-8 24-5-11 3-7-7 28-1-1 3-9-15 13-8
 31-11-0 33-2-8
 Scale = 1:52.6

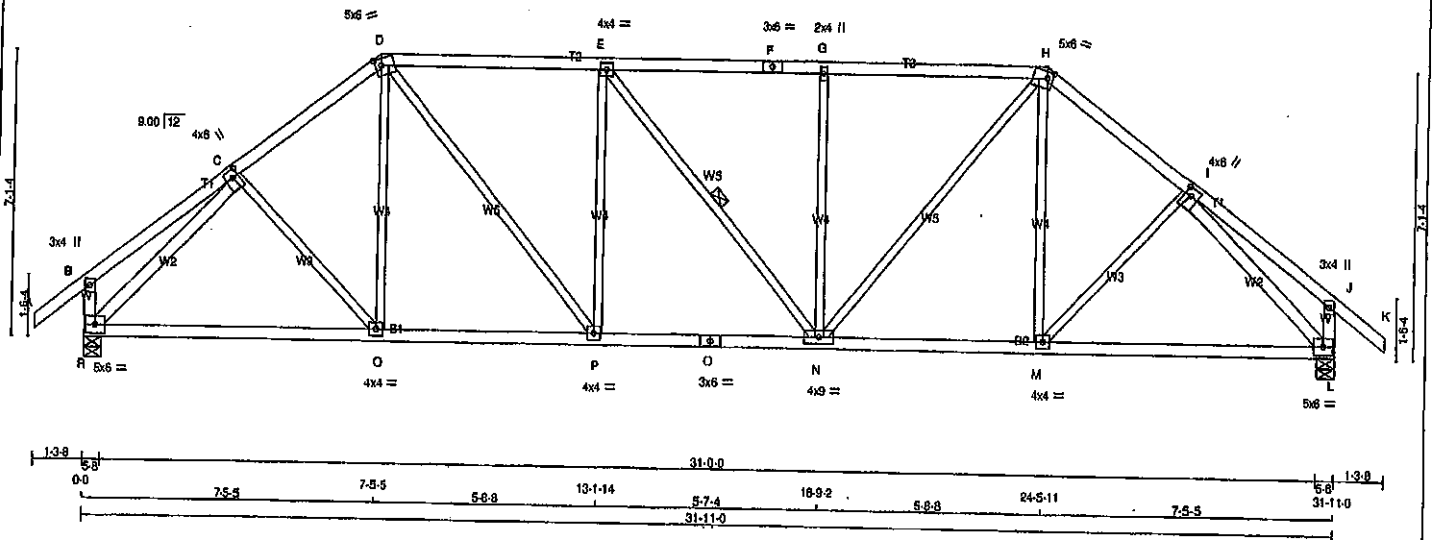

LUMBER N.L.G.A. RULES CHORDS SIZE LUMBER DESCR. DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS

ALL WEBS EXCEPT	SIZE	DRY	No.2	DESCR.	SPF	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
A - D	2x4	DRY	No.2	SPF	SPF	JT	JT	JT	JT
D - F	2x4	DRY	No.2	SPF	SPF	R	R	R	R
F - H	2x4	DRY	No.2	SPF	SPF	L	L	L	L
H - K	2x4	DRY	No.2	SPF	SPF				
R - B	2x4	DRY	No.2	SPF	SPF				
L - J	2x4	DRY	No.2	SPF	SPF				
R - O	2x4	DRY	No.2	SPF	SPF				
O - L	2x4	DRY	No.2	SPF	SPF				
ALL WEBS EXCEPT	2x4	DRY	No.2	SPF	SPF				
R - C	2x4	DRY	No.2	SPF	SPF				
I - L	2x4	DRY	No.2	SPF	SPF				

DRY: SEASONED LUMBER. TOTAL WEIGHT = 2 X 146 = 291 lb

DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 8.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C. LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM. THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH: - PART 9 OF NBC 2010, NBC 2012, ABC 2019 - PART 9 OF NBC 2012 (2019 AMENDMENT) - CSA 086-09, CSA 086-14 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.08") CALCULATED VERT. DEFL. (LL) = L/999 (0.09") ALLOWABLE DEFL. (TL) = L/360 (1.08") CALCULATED VERT. DEFL. (TL) = L/999 (0.17")

CSI: TO=0.52/1.00 (D-E-1), BC=0.39/1.00 (N-P-1), WB=0.73/1.00 (L-1), SS=0.24/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00 AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 818 354 1887 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg.


SI GRIP = 0.89 (P) (INPUT = 0.90) SI METAL = 0.94 (I) (INPUT = 1.00)

Structural component only DWG# T-2006185

LICENSED PROFESSIONAL ENGINEER H. J. G. ALVES 100009024 PROVINCE OF ONTARIO

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408157	T5	7	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Wed Apr 15 12:13:29 2020 Page 1
 ID:7R4Dg_C9IAuIONuKplv7nzzlwO4-w8IYK7e9IicR7jkZhR7Q8JZMamYtv8OaKQUIMqzQUHk
 1-3-8 0-0 4-5-15 4-5-15 4-3-7 6-9-5 7-2-3 15-11-8 7-2-3 23-1-11 4-3-7 27-5-1 4-5-15 31-11-0 31-2-8
 Scale = 1:52.6

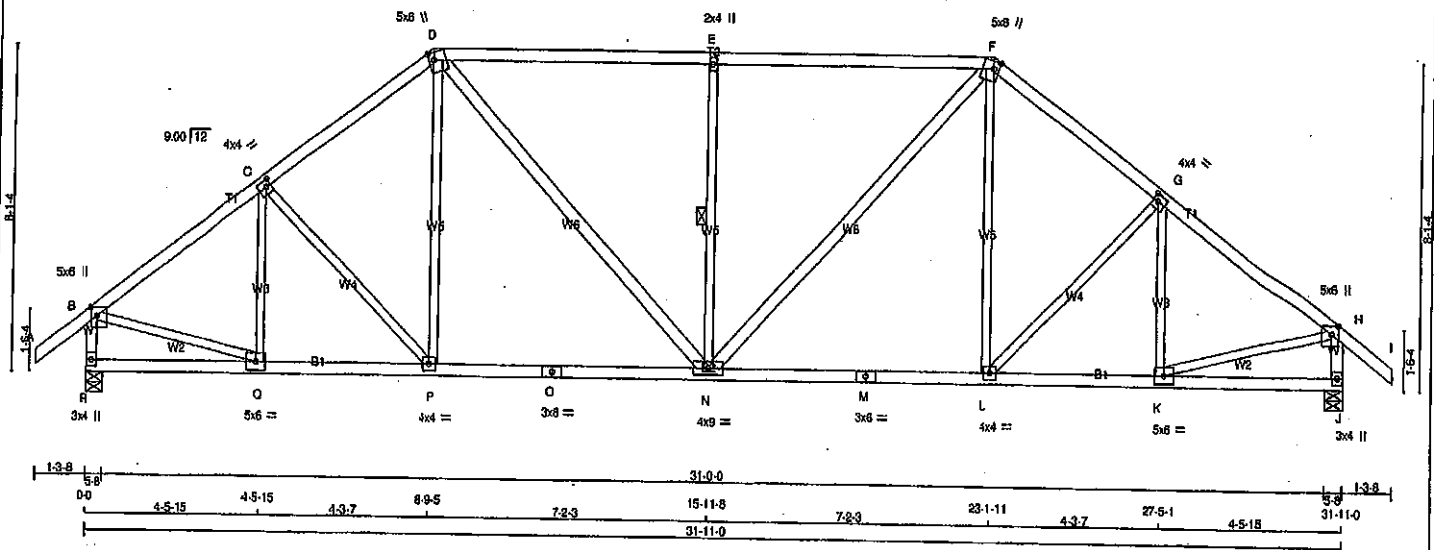

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	5.0	6.0	2.50 2.00
C	TMVW-t	MT20	4.0	4.0	2.00 1.50
D	TTVW+m	MT20	5.0	6.0	2.25 1.50
E	TMVW-t	MT20	2.0	4.0	
F	TTVW+m	MT20	5.0	6.0	2.25 1.50
G	TMVW-t	MT20	4.0	4.0	2.00 1.50
H	TMVW+p	MT20	5.0	6.0	2.50 2.00
J	BMV1+p	MT20	3.0	4.0	
K	BMVW-t	MT20	5.0	6.0	
L	BMVW-t	MT20	4.0	4.0	
M	BS-t	MT20	3.0	6.0	
N	BMVW-t	MT20	4.0	4.0	
O	BS-t	MT20	3.0	6.0	
P	BMVW-t	MT20	4.0	4.0	
Q	BMVW-t	MT20	5.0	6.0	
R	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG	
JT	VERT	HORZ	DOWN	UPLIFT	IN-SX
R	1888	0	1888	0	5-8
J	1888	0	1888	0	5-8

UNFACTORED REACTIONS						
1ST CASE	MAX/MIN	COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
R	1331	887/0	0/0	0/0	0/0	444/0
J	1331	887/0	0/0	0/0	0/0	444/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.00 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
A-B	0/38	-91.8 -91.8	0.12 (1)	10.00	Q-C	-332/0	0.12 (1)
B-C	-1894/0	-91.8 -91.8	0.27 (1)	4.64	C-P	-138/0	0.10 (1)
C-D	-1835/0	-91.8 -91.8	0.27 (1)	4.71	P-D	0/212	0.09 (4)
D-E	-1881/0	-91.8 -91.8	0.69 (1)	4.00	D-N	0/644	0.10 (1)
E-F	-1881/0	-91.8 -91.8	0.69 (1)	4.00	N-F	-810/0	0.34 (1)
F-G	-1835/0	-91.8 -91.8	0.27 (1)	4.71	N-F	0/644	0.10 (1)
G-H	-1894/0	-91.8 -91.8	0.27 (1)	4.64	L-F	0/212	0.09 (4)
H-I	0/38	-91.8 -91.8	0.12 (1)	10.00	L-G	-138/0	0.10 (1)
R-B	-1848/0	0.0 0.0	0.19 (1)	5.16	K-G	-332/0	0.12 (1)
J-H	-1848/0	0.0 0.0	0.19 (1)	5.16	B-Q	0/1591	0.38 (1)
					K-H	0/1591	0.38 (1)
R-Q	0/0	-18.5 -18.5	0.08 (4)	10.00			
Q-P	0/1537	-18.5 -18.5	0.32 (1)	10.00			
P-O	0/1445	-18.5 -18.5	0.34 (1)	10.00			
O-N	0/1445	-18.5 -18.5	0.34 (1)	10.00			
N-M	0/1445	-18.5 -18.5	0.34 (1)	10.00			
M-L	0/1445	-18.5 -18.5	0.34 (1)	10.00			
L-K	0/1537	-18.5 -18.5	0.32 (1)	10.00			
K-J	0/0	-18.5 -18.5	0.08 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 BOT CH. LL = 0.0 PSF
 DL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBC 2010, NBC 2012, ABC 2019
 - PART 9 OF NBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
 ALLOWABLE DEFL.(TL) = L/360 (1.06")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CS: TC=0.89/1.00 (E-F:1), BC=0.34/1.00 (N-P:1), WB=0.38/1.00 (B-Q:1), SS=0.32/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
 PLATE GRIP(PRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 384 1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.90)
 JSI METAL= 0.53 (O) (INPUT = 1.00)

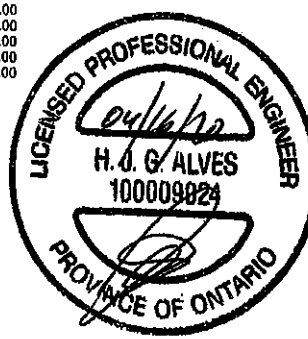

Structural component only
 DWG# T-2008186

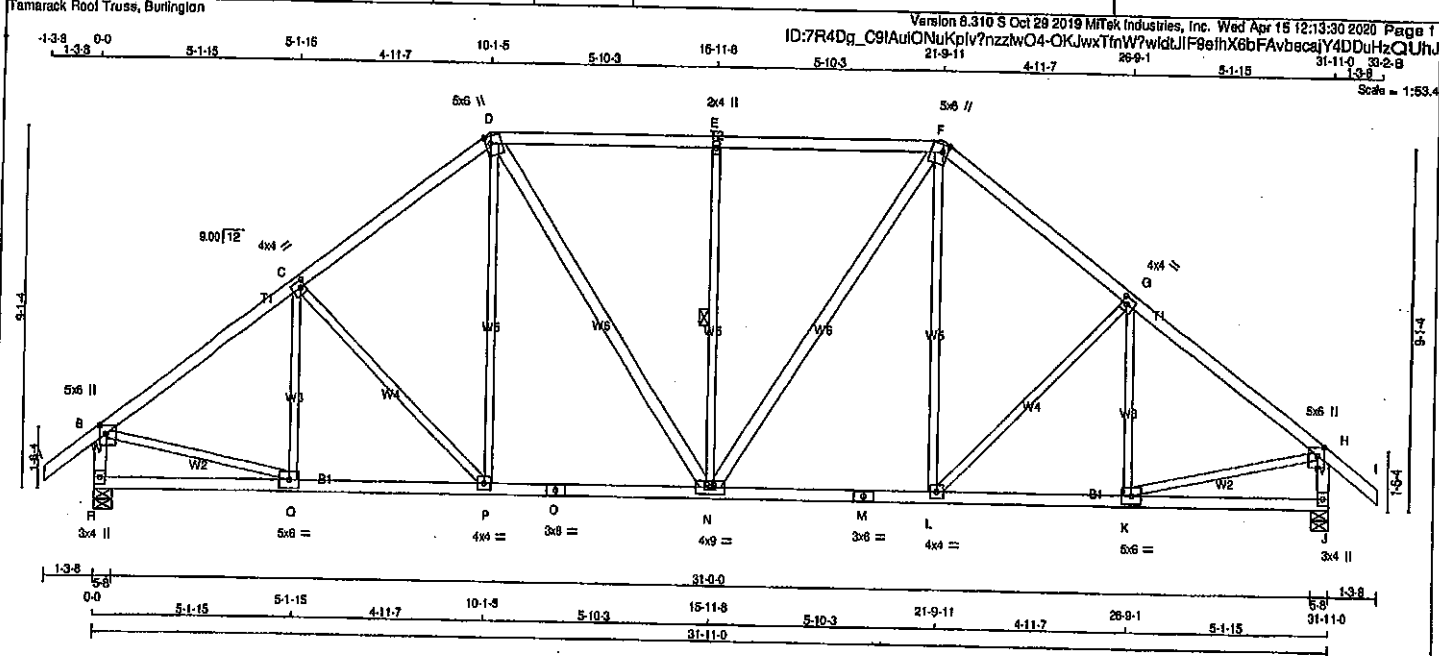

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
J - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (Table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	2.50	2.00
C	TMVW-1	MT20	4.0	4.0	2.00	1.50
D	TTWW+m	MT20	5.0	8.0	2.25	1.50
E	TMVW+w	MT20	2.0	4.0		
F	TTWW+m	MT20	5.0	6.0	2.25	1.50
G	TMVW-1	MT20	4.0	4.0	2.00	1.50
H	TMVW+p	MT20	5.0	6.0	2.50	2.00
J	BMV1+p	MT20	3.0	4.0		
K	BMVW-1	MT20	5.0	6.0		
L	BMVW-1	MT20	4.0	4.0		
M	BS-1	MT20	3.0	6.0		
N	BMVWW-1	MT20	4.0	9.0		
O	BS-1	MT20	3.0	6.0		
P	BMVW-1	MT20	4.0	4.0		
Q	BMVW-1	MT20	5.0	6.0		
R	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	DOWN	UPLIFT	IN-SX
R	1888	0	1888	0
J	1888	0	1888	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE	
R	1331	887/0	0/0	0/0	0/0
J	1331	887/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.51 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)		MAX. UNBRACED LENGTH (FT)	WESS MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
		FROM	TO				
FR-TO							
A-B	0/38	-91.8	-91.8	0.12 (1)	10.00	Q-C	-262/0
B-C	-1924/0	-91.8	-91.8	0.37 (1)	4.51	Q-P	-256/0
C-D	-1767/0	-91.8	-91.8	0.35 (1)	4.69	P-D	0/282
D-E	-1642/0	-91.8	-91.8	0.44 (1)	4.67	D-N	0/459
E-F	-1642/0	-91.8	-91.8	0.44 (1)	4.67	N-E	-856/0
F-G	-1767/0	-91.8	-91.8	0.35 (1)	4.69	N-F	0/459
G-H	-1924/0	-91.8	-91.8	0.37 (1)	4.51	L-F	0/282
H-I	0/38	-91.8	-91.8	0.12 (1)	10.00	L-G	-256/0
R-B	-1845/0	0.0	0.0	0.19 (1)	8.16	K-G	-262/0
J-H	-1845/0	0.0	0.0	0.19 (1)	8.16	B-Q	0/1807
						K-H	0/1807
R-Q	0/0	-18.5	-18.5	0.11 (4)	10.00		
Q-P	0/1585	-18.5	-18.5	0.31 (1)	10.00		
P-O	0/1388	-18.5	-18.5	0.29 (1)	10.00		
O-N	0/1388	-18.5	-18.5	0.29 (1)	10.00		
N-M	0/1388	-18.5	-18.5	0.29 (1)	10.00		
M-L	0/1388	-18.5	-18.5	0.29 (1)	10.00		
L-K	0/1585	-18.5	-18.5	0.31 (1)	10.00		
K-J	0/0	-18.5	-18.5	0.11 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06')

CALCULATED VERT. DEFL.(LL) = L/999 (0.07')

ALLOWABLE DEFL.(TL) = L/360 (1.06')

CALCULATED VERT. DEFL.(TL) = L/999 (0.13')

CSI: TC=0.44/1.00 (D-E:1), BC=0.31/1.00 (K-L:1), WB=0.38/1.00 (H-K:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 L.S BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1687 768 1997 1658	

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

SI GRIP = 0.89 (B) (INPUT = 0.90)

SI METAL = 0.44 (C) (INPUT = 1.00)

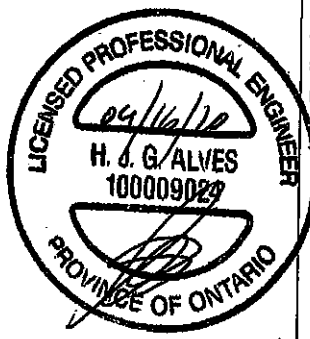

JOB NAME 408157	TRUSS NAME T7S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

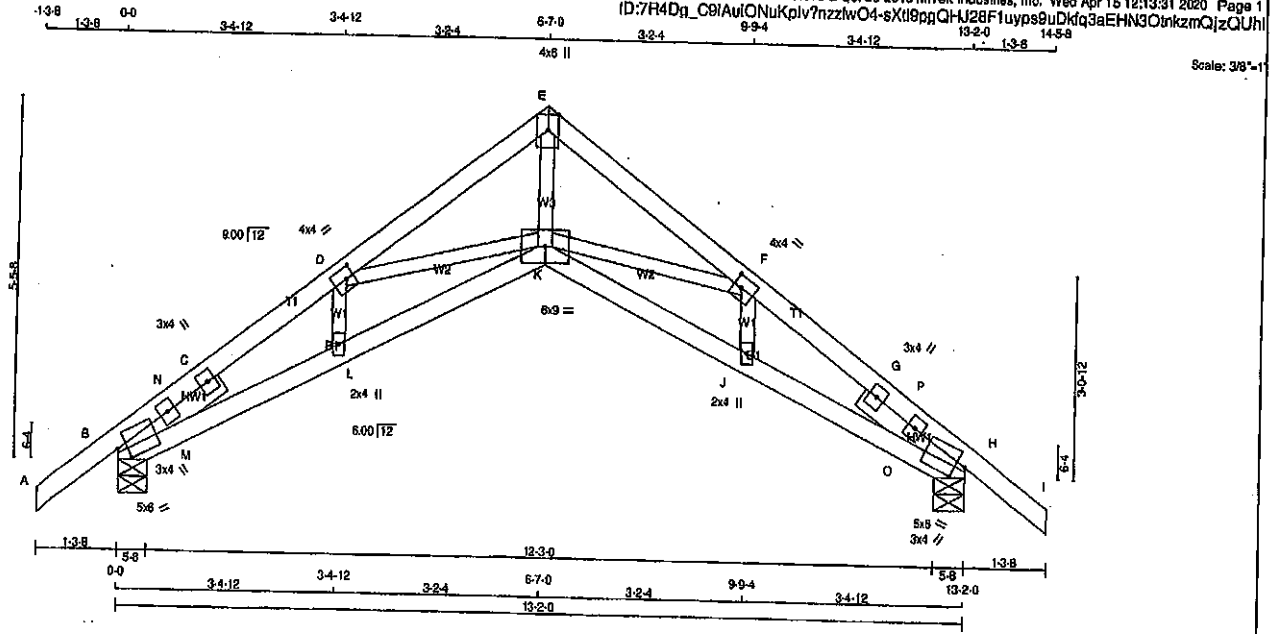

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - E	2x4 DRY	No.2	SPF
E - I	2x4 DRY	No.2	SPF
B - K	2x4 DRY	No.2	SPF
K - H	2x4 DRY	No.2	SPF
REINFORCING MEMBERS			
HW1	2x4 DRY	No.2	SPF
HW2	2x4 DRY	No.2	SPF
ALL WEBS			
2x3 DRY	SEASONED LUMBER	No.2	SPF
PLATES (table is in inches)			
JT TYPE	PLATES	W	LEN Y X
B TMBMR1-I	MT20	5.0	6.0 2.75 1.50
B, B, H, H			
B RT-I	MT20	3.0	4.0
D TWW-I	MT20	4.0	4.0 2.00 1.50
E ITW-I	MT20	4.0	8.0 Edge
F TWW-I	MT20	4.0	4.0 2.00 1.50
H TMBMR1-I	MT20	5.0	6.0 2.75 1.50
J BMW-I	MT20	2.0	4.0
K BBWW-I	MT20	6.0	9.0
L BMW-I	MT20	2.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
<u>BEARINGS</u>							
	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
B	852	0	852	0	0	5-8	5-8
H	852	0	852	0	0	5-8	5-8
<u>UNFACTORED REACTIONS</u>							
	1ST CASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
B	600	407 / 0	0 / 0	0 / 0	0 / 0	193 / 0	0 / 0
H	600	407 / 0	0 / 0	0 / 0	0 / 0	193 / 0	0 / 0
BEARING MATERIAL TO BE SFF NO.2 OR BETTER AT JOINT(S) B, H							

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, H
BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.16 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS									
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)	MEMB.
FR-TO		FROM TO	CSI (LC)	FR-TO			CSI (LC)	FR-TO	
A-B	0 / 26	-91.8	-91.8 0.12 (1)	10.00	K-E	0 / 1446	0.33 (1)		
B-N	-1620 / 0	-91.8	-91.8 0.07 (1)	5.16	K-F	-230 / 0	0.05 (1)		
N-C	-1389 / 0	-91.8	-91.8 0.17 (1)	5.35	J-F	-20 / 41	0.01 (4)		
C-D	-1389 / 0	-91.8	-91.8 0.17 (1)	5.35	D-K	-20 / 41	0.05 (1)		
D-E	-1454 / 0	-91.8	-91.8 0.18 (1)	5.25	L-D	-20 / 41	0.01 (4)		
E-F	-1454 / 0	-91.8	-91.8 0.18 (1)	5.25	M-N	0 / 828	0.00 (1)		
F-G	-1389 / 0	-91.8	-91.8 0.17 (1)	5.35	M-C	-937 / 0	0.10 (1)		
G-P	-1389 / 0	-91.8	-91.8 0.17 (1)	5.35	O-P	0 / 828	0.00 (1)		
P-H	-1620 / 0	-91.8	-91.8 0.07 (1)	5.15	O-G	-937 / 0	0.10 (1)		
H-I	0 / 26	-91.8	-91.8 0.12 (1)	10.00					
B-M	0 / 1174	-18.5	-18.5 0.28 (1)	10.00					
M-L	0 / 1537	-18.5	-18.5 0.34 (1)	10.00					
L-K	0 / 1568	-18.5	-18.5 0.34 (1)	10.00					
K-J	0 / 1568	-18.5	-18.5 0.34 (1)	10.00					
J-O	0 / 1537	-18.5	-18.5 0.34 (1)	10.00					
O-H	0 / 1174	-18.5	-18.5 0.28 (1)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2010, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.44")
CALCULATED VERT. DEFL. (LL) = L/999 (0.08")
ALLOWABLE DEFL. (TL) = L/360 (0.44")
CALCULATED VERT. DEFL. (TL) = L/999 (0.15")

CSI: TC=0.18/1.00 (E-F:1), BC=0.34/1.00 (J-K:1), WB=0.33/1.00 (E-K:1), SS=0.28/1.00 (F-P:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1856


PLATE PLACEMENT TOL. = 0.250 inches
 PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.72 (K) (INPUT = 0.90)
 JSI METAL = 0.80 (H) (INPUT = 1.00)

Structural component only
DWG# T-2006188

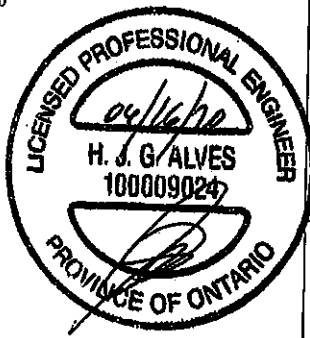

JOB NAME 408157	TRUSS NAME T8	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

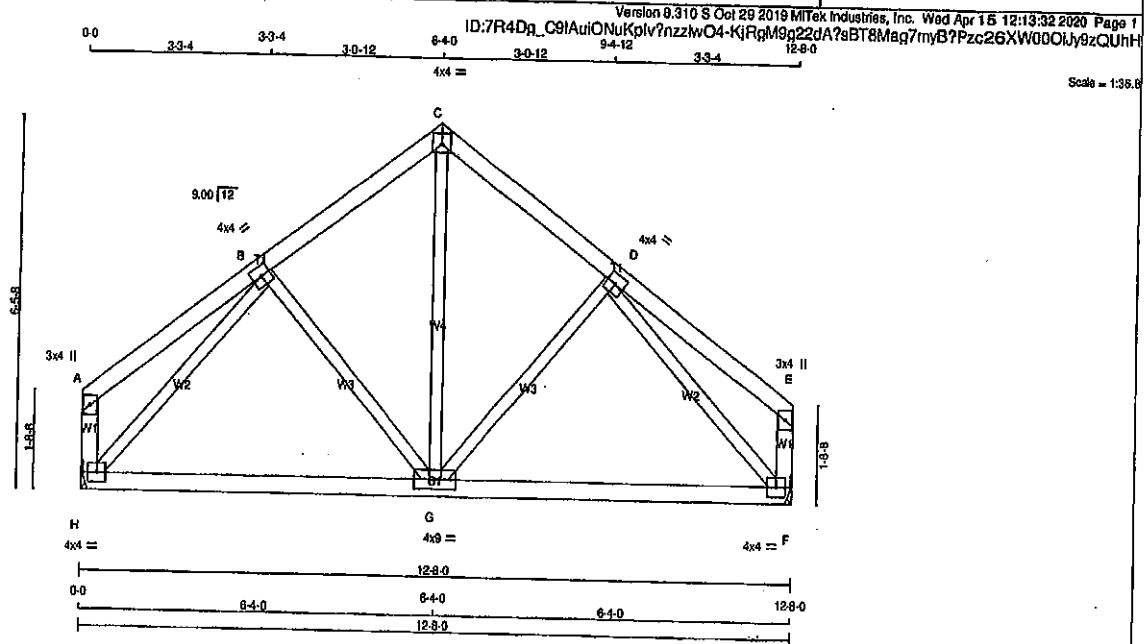

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
A - G	2x4 DRY	No.2
C - E	2x4 DRY	No.2
H - A	2x4 DRY	No.2
F - E	2x4 DRY	No.2
H - F	2x4 DRY	No.2

ALL WEBS 2x3 DRY EXCEPT No.2

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

DESOR.	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	IN-SX	IN-SX
H	698	0	0	MECHANICAL
F	698	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H, F. MINIMUM BEARING LENGTH AT JOINT H = 1-8, JOINT F = 1-8.

TOTAL WEIGHT = 2 X 65 = 111 lb

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMV-p MT20	3.0	4.0		
B	TMWW-t MT20	4.0	4.0		
C	TTW-p MT20	4.0	4.0	2.25	2.00
D	TMWW-t MT20	4.0	4.0		
E	TMV-p MT20	3.0	4.0		
F	BMVW1-t MT20	4.0	4.0		
G	BMVWW1-t MT20	4.0	8.0		
H	BMVW1-t MT20	4.0	4.0		

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS
	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
H	494	324 / 0 0 / 0 0 / 0 0 / 0 170 / 0 0 / 0
F	494	324 / 0 0 / 0 0 / 0 0 / 0 170 / 0 0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LO1 MAX. MAX. (PLF) CSI (LC)	MEMB.	FORCE (LBS) MAX. CSI (LC)
FR-TO		FROM TO	FR-TO	
A-B	0 / 20	-91.8 -91.8 0.14 (1) 10.00	G-C	0 / 334 0.08 (1)
B-C	-488 / 0	-91.8 -91.8 0.11 (1) 8.25	G-D	-125 / 0 0.05 (1)
C-D	-488 / 0	-91.8 -91.8 0.11 (1) 8.25	B-G	-125 / 0 0.05 (1)
D-E	0 / 20	-91.8 -91.8 0.14 (1) 10.00	H-B	-708 / 0 0.27 (1)
H-A	-111 / 0	0.0 0.0 0.01 (1) 7.81	D-F	-708 / 0 0.27 (1)
F-E	-111 / 0	0.0 0.0 0.01 (1) 7.81		
H-G	0 / 458	-18.5 -18.5 0.25 (4) 10.00		
G-F	0 / 458	-18.5 -18.5 0.25 (4) 10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

OL = 6.0 PSF

BOT CH. LL = 0.0 PSF

OL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.42")

CALCULATED VERT. DEFL. (LL) = L/999 (0.01")

ALLOWABLE DEFL. (TL) = L/360 (0.42")

CALCULATED VERT. DEFL. (TL) = L/999 (0.04")

CSI: TC=0.14/1.00 (D-E:1), BC=0.25/1.00 (G-H:4), WB=0.27/1.00 (D-F:1), SS=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
	(PS)	(PL)	(PL)
MT20	618	354	1867 788 1987 1866

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.77 (B) (INPUT = 0.90)

JSI METAL = 0.26 (D) (INPUT = 1.00)

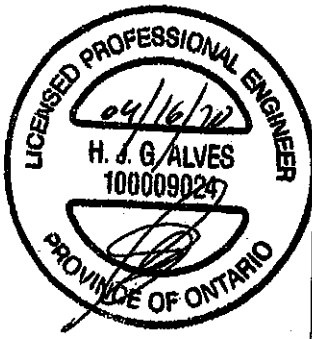


Structural component only
DWG# T-2006189

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408157	T9	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Wed Apr 16 12:13:33 2020 Page 1
ID:7R4Dg_C9IAuIONuKpiv7nzzlwO4-pv73aVhgpwisUL2KwHBMJ9k8nNz4r1x9F2SIVczQUhG

Scale = 1:31.3

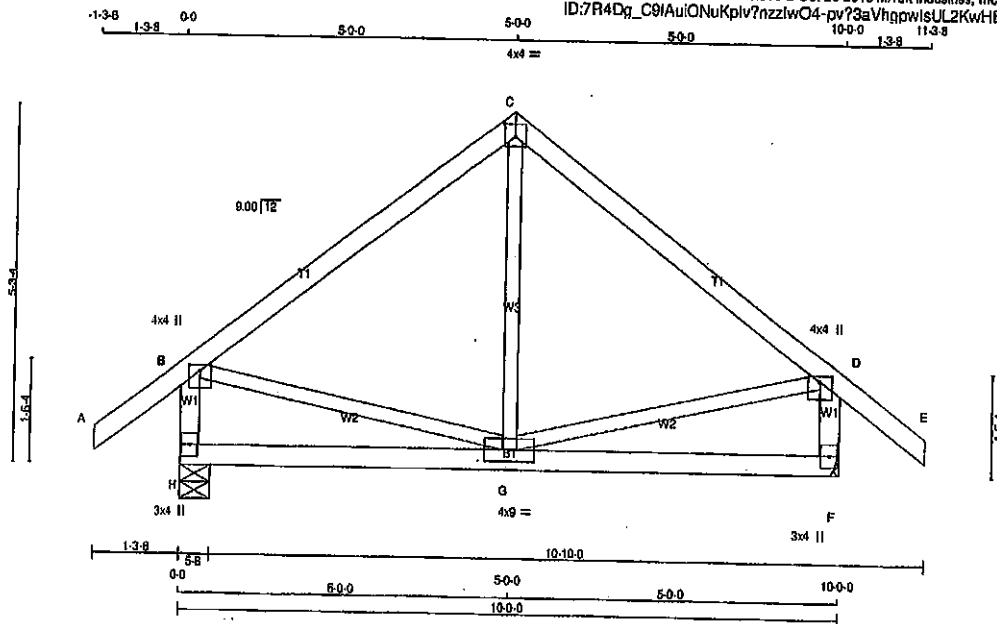

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2	
C - E	2x4	DRY	No.2	
H - B	2x4	DRY	No.2	
F - D	2x4	DRY	No.2	
H - F	2x4	DRY	No.2	

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C TTW+p	MT20	4.0	4.0	2.25	2.00
D TMVW+p	MT20	4.0	4.0	1.00	2.00
F BMV1+p	MT20	3.0	4.0		
G BMVWW-t	MT20	4.0	9.0		
H BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
H	678	0	678	0
F	678	0	678	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LOSE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	477	328 / 0	0 / 0	0 / 0	0 / 0	151 / 0	0 / 0	0 / 0
F	477	328 / 0	0 / 0	0 / 0	0 / 0	151 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	FACTORED LOAD LC1 MAX. (PL)	MAX. CS1 (LC)	UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO							FR-TO			
A-B	0 / 38	-91.8	-91.8	0.12 (1)	10.00		G-C	-24 / 77	0.03 (4)	
B-C	-362 / 0	-91.8	-91.8	0.39 (1)	6.25		B-G	0 / 298	0.07 (1)	
C-D	-362 / 0	-91.8	-91.8	0.39 (1)	6.25		G-D	0 / 298	0.07 (1)	
D-E	0 / 38	-91.8	-91.8	0.12 (1)	10.00					
H-B	-642 / 0	0.0	0.0	0.07 (1)	7.81					
F-D	-642 / 0	0.0	0.0	0.07 (1)	7.81					
H-G	0 / 0	-18.5	-18.5	0.13 (4)	10.00					
G-F	0 / 0	-18.5	-18.5	0.13 (4)	10.00					

TOTAL WEIGHT = 3 X 44 = 132 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.8 PSF
DL	= 6.0 PSF
BOY CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.33")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.33")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.02")

CS1: TC=0.30/1.00 (C-D:1), BC=0.13/1.00 (F-G:4), WB=0.07/1.00 (B-G:1), SS=0.14/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1667


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.59 (D) (INPUT = 0.90)
JSI METAL = 0.15 (D) (INPUT = 1.00)



Structural component only
DWG# T-2006190

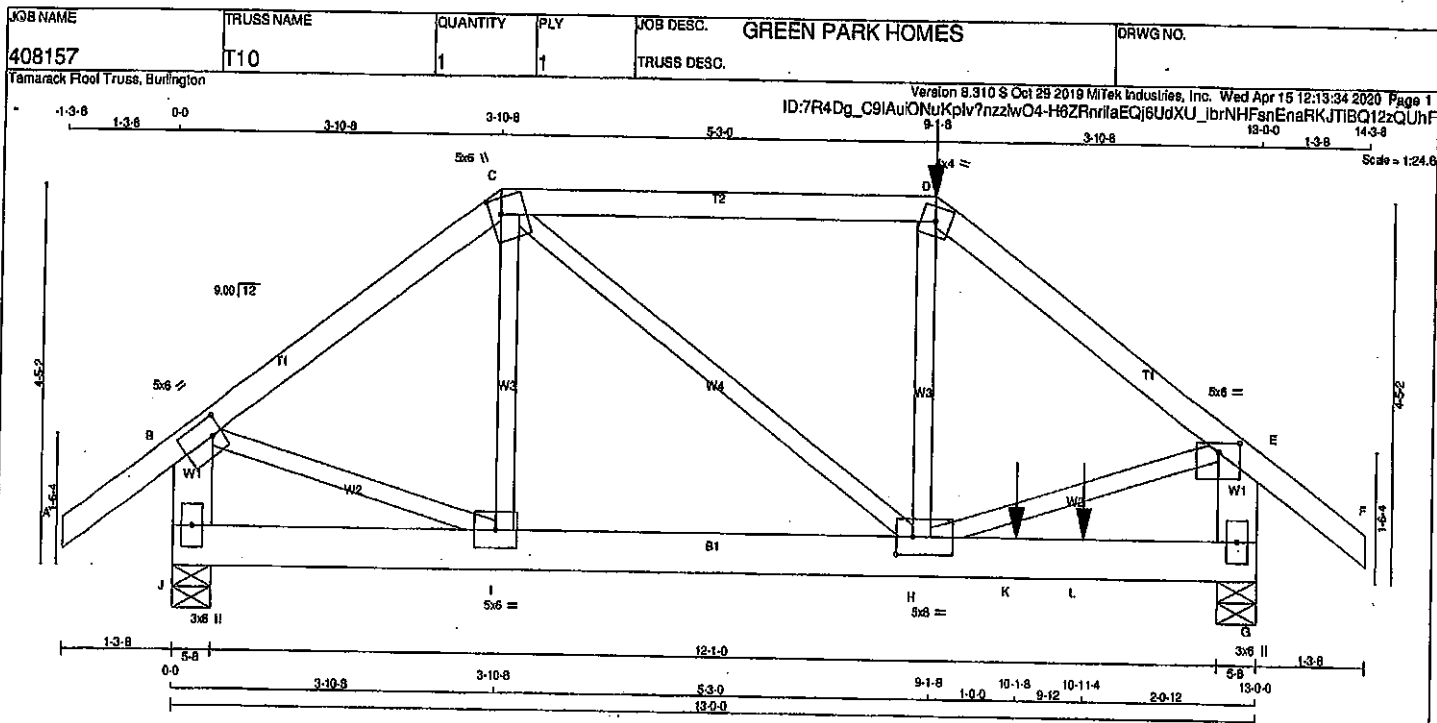

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
J - B	2x6	DRY	No.2	SPF
G - E	2x6	DRY	No.2	SPF
J - G	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	5.0	8.0	2.50	1.50
C	TTWW-m	MT20	5.0	8.0	2.25	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMVW-p	MT20	5.0	6.0	1.25	3.00
G	BMV1+p	MT20	3.0	6.0		
H	BMVWV-1	MT20	5.0	8.0	2.50	2.50
I	BMVWV-1	MT20	5.0	8.0		
J	BMV1+p	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	0	0
J	1141	0	0	0
G	1826	0	0	0

UNFACTORED REACTIONS

1ST CASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED
J	802
G	1282

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.94 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)
A-B	0/38	-91.8	-91.8	0.14 (1)	10.00	1-C	-214/6	0.08 (1)	0.08 (1)
B-C	-954/0	-91.8	-91.8	0.28 (1)	5.98	C-H	0/599	0.15 (1)	0.15 (1)
C-D	-1228/0	-91.8	-91.8	0.53 (1)	4.99	H-D	0/302	0.07 (1)	0.07 (1)
D-E	-1528/0	-91.8	-91.8	0.31 (1)	4.94	B-I	0/791	0.20 (1)	0.20 (1)
E-F	0/38	-91.8	-91.8	0.14 (1)	10.00	H-E	0/1268	0.31 (1)	0.31 (1)
J-B	-1091/0	0.0	0.0	0.09 (1)	7.81				
G-E	-1585/0	0.0	0.0	0.11 (1)	7.80				
J-I	0/0	-18.5	-18.5	0.05 (1)	10.00				
I-H	0/758	-18.5	-18.5	0.33 (1)	10.00				
H-K	0/0	-18.5	-18.5	0.49 (1)	10.00				
K-L	0/0	-18.5	-18.5	0.49 (1)	10.00				
L-G	0/0	-18.5	-18.5	0.49 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
D	9-1-8	-200	-200	---	BACK	VERT	TOTAL	---	C1
K	10-1-8	-1063	-1063	---	BACK	VERT	TOTAL	---	C1
L	10-11-4	-17	-17	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/G

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.43")

CALCULATED VERT. DEFL. (LL) = L/889 (0.03")

ALLOWABLE DEFL. (TL) = L/360 (0.43")

CALCULATED VERT. DEFL. (TL) = L/889 (0.03")

CSI: TO=0.59/1.00 (C-D:1), BC=0.49/1.00 (G-H:1), WB=0.31/1.00 (E-H:1), SSI=0.59/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (D) (INPUT = 0.90)

JSI METAL = 0.34 (E) (INPUT = 1.00)

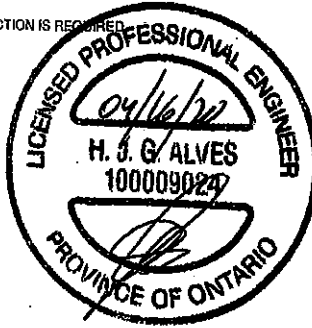


Structural component only
DWG# T-2006191

JOB NAME 408157	TRUSS NAME T11	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Famersack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 12:13:35 2020 Page 1
ID:7R4Dg_C9IAuIONuKplv?nzzhwC4-I6p_AjwLY8jC1IEqOapSTBdTJxySiMxzZuZQUhE

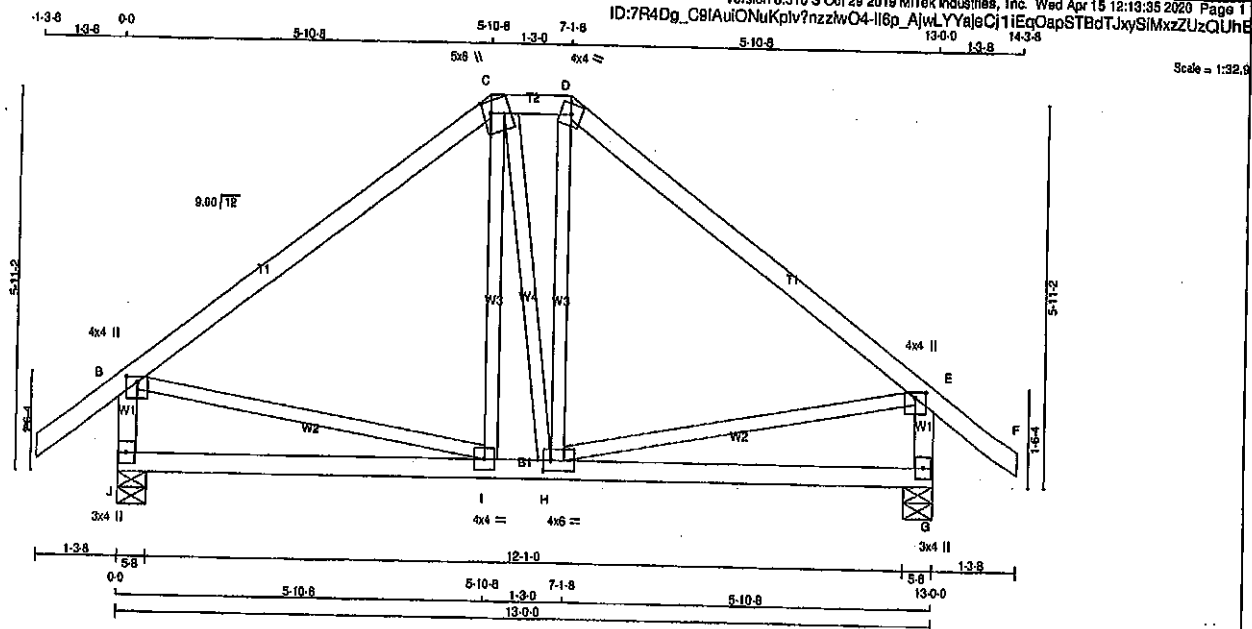

Scale = 1:32.0

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
J - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
J - G	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C TTWW+m	MT20	5.0	6.0	2.25	1.50
D TTW-m	MT20	4.0	4.0		
E TMVW+p	MT20	4.0	4.0	1.00	2.00
G BMVW+p	MT20	3.0	4.0		
H BMVWV+I	MT20	4.0	6.0	2.00	1.50
I BMVWV-I	MT20	4.0	4.0		
J BMVW+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	SPF	VERT	HORZ	DOWN	UP
J	SPF	843	0	843	0
G	SPF	843	0	843	0

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	594	403/0	0/0	0/0	0/0	0/0	0/0	191/0	0/0
G	594	403/0	0/0	0/0	0/0	0/0	0/0	191/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT.	LOAD (LBS)	MEMB.	FORCE (LBS)	VERT.	LOAD (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0/38	-91.8	-91.8 0.12 (1)	10.00	I-C	-12/48	0.02 (4)
B-C	-529/0	-91.8	-91.8 0.41 (1)	8.25	C-H	0/7	0.00 (4)
C-D	-423/0	-91.8	-91.8 0.02 (1)	6.25	H-D	-8/55	0.02 (4)
D-E	-530/0	-91.8	-91.8 0.41 (1)	8.25	B-I	0/431	0.10 (1)
E-F	0/38	-91.8	-91.8 0.12 (1)	10.00	H-E	0/431	0.10 (1)
J-B	-798/0	0.0	0.0 0.08 (1)	7.81			
G-E	-798/0	0.0	0.0 0.08 (1)	7.81			
J-I	0/0	-18.5	-18.5 0.15 (4)	10.00			
I-H	0/422	-18.5	-18.5 0.20 (4)	10.00			
H-G	0/0	-18.5	-18.5 0.16 (4)	10.00			

TOTAL WEIGHT = 62 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
BOT CH. LL = 8.0 PSF
DL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.43")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.43")
CALCULATED VERT. DEFL. (TL) = L/999 (0.04")

CSI: TC=0.41/1.00 (D-E:1), BC=0.20/1.00 (H-I:4), WB=0.10/1.00 (E-H:1), SS=0.17/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


ISI GRIP=0.78 (E) (INPUT = 0.90)
ISI METAL=0.20 (E) (INPUT = 1.00)

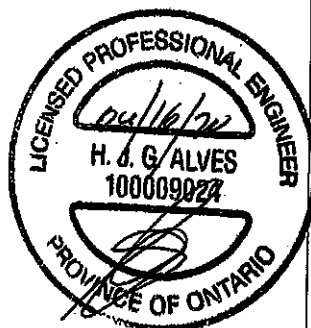

Structural component only
DWG# T-2006192

JOB NAME 408157	TRUSS NAME T12	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Wed Apr 15 12:13:36 2020 Page 1
ID:7R4Dg_C9IAuIONuKplv7nzzwO4-DUGBCWjY6gRLonvbPI3woMdgbyQ2Kkx0gX5wzQUhD
8-7-4 3-4-0 11-11-4 13-0-0

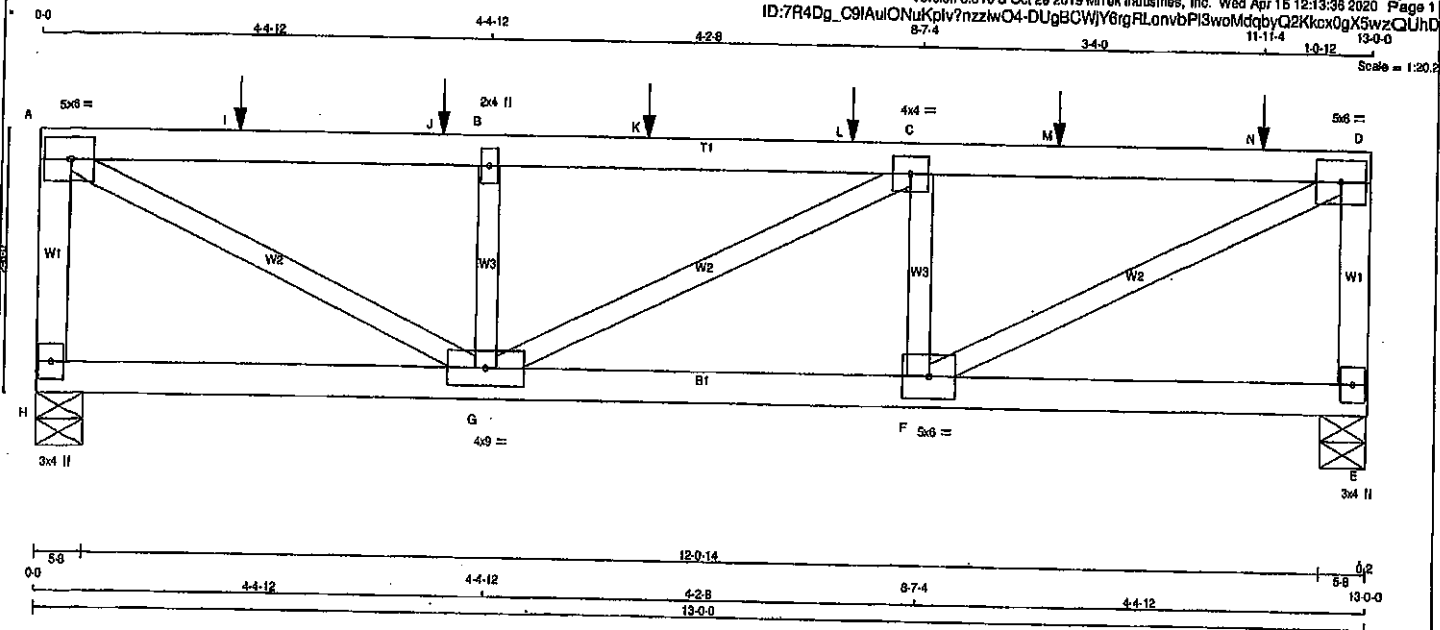

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
H - A	2x4	DRY	No.2	SPF	
A - D	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	
H - E	2x4	DRY	No.2	SPF	
ALL WEBS 2x3 DRY No.2 SPF					
DRY: SEASONED LUMBER.					

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
H-A 1 12		TOP
A-D 1 12		SIDE(0.0)
D-E 1 12		TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
H-E 1 12		TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	5.0	6.0			
B	TMVW-1	MT20	2.0	4.0			
C	TMVW-1	MT20	4.0	4.0			
D	TMVW-1	MT20	5.0	6.0			
E	BMV1+p	MT20	3.0	4.0			
F	BMVW-1	MT20	5.0	6.0			
G	BMVW-1	MT20	4.0	8.0			
H	BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	DOWN	UP	IN-SX
H	1929 0	1929 0	0 0	5-8 5-8
E	2104 0	2104 0	0 0	5-8 5-8

UNFACTORED REACTIONS	1ST CASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
H	1382	909 / 0 0 / 0 0 / 0 0 / 0 452 / 0 0 / 0
E	1485	992 / 0 0 / 0 0 / 0 0 / 0 492 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)		
FR-TO		FROM TO			FR-TO				
H-A	-1885 / 0	0.0	0.0	0.12 (1)	F-D	0 / 3404	0.38 (1)		
A-I	-3008 / 0	-91.8	-91.8	0.43 (1)	A-G	0 / 3367	0.38 (1)		
I-J	-3008 / 0	-91.8	-91.8	0.43 (1)	F-C	-1450 / 0	0.11 (1)		
J-B	-3008 / 0	-91.8	-91.8	0.43 (1)	G-B	-1419 / 0	0.11 (1)		
B-K	-3008 / 0	-91.8	-91.8	0.43 (1)	G-C	-37 / 0	0.01 (1)		
K-L	-3008 / 0	-91.8	-91.8	0.43 (1)					
L-C	-3008 / 0	-91.8	-91.8	0.43 (1)					
C-M	-3041 / 0	-91.8	-91.8	0.44 (1)					
M-N	-3041 / 0	-91.8	-91.8	0.44 (1)					
N-D	-3041 / 0	-91.8	-91.8	0.44 (1)					
E-D	-2051 / 0	0.0	0.0	0.13 (1)					

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.
I	1-11-4	-433	-433	---	---	BACK	VERT
J	3-11-4	-433	-433	---	---	BACK	VERT
K	5-11-4	-433	-433	---	---	BACK	VERT
L	7-11-4	-433	-433	---	---	BACK	VERT
M	9-11-4	-433	-433	---	---	BACK	VERT
N	11-11-4	-433	-433	---	---	BACK	VERT

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 48 = 96 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 8 OF NBCG 2018, CBC 2012, ABC 2019
- PART 9 OF NBCG 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.43")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.43")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.44/1.00 (C-D:1), BC=0.28/1.00 (F-G:1), WB=0.38/1.00 (D-F:1), SSI=0.35/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MT20	618	354	1887 768 1887 1658

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.88 (G) (INPUT = 0.90)
JSI METAL= 0.38 (D) (INPUT = 1.00)

Structural component only
DWG# T-2006193

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408157	T13	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 28 2019 Mittek Industries, Inc. Wed Apr 15 12:13:37 2020 Page 1
ID:7R4Dg_C9IAuIONuKpiv?nzzlwO4-hgE2PskAt9oizyL697GIT?va1_KcnqE19gO4eNzQUhC

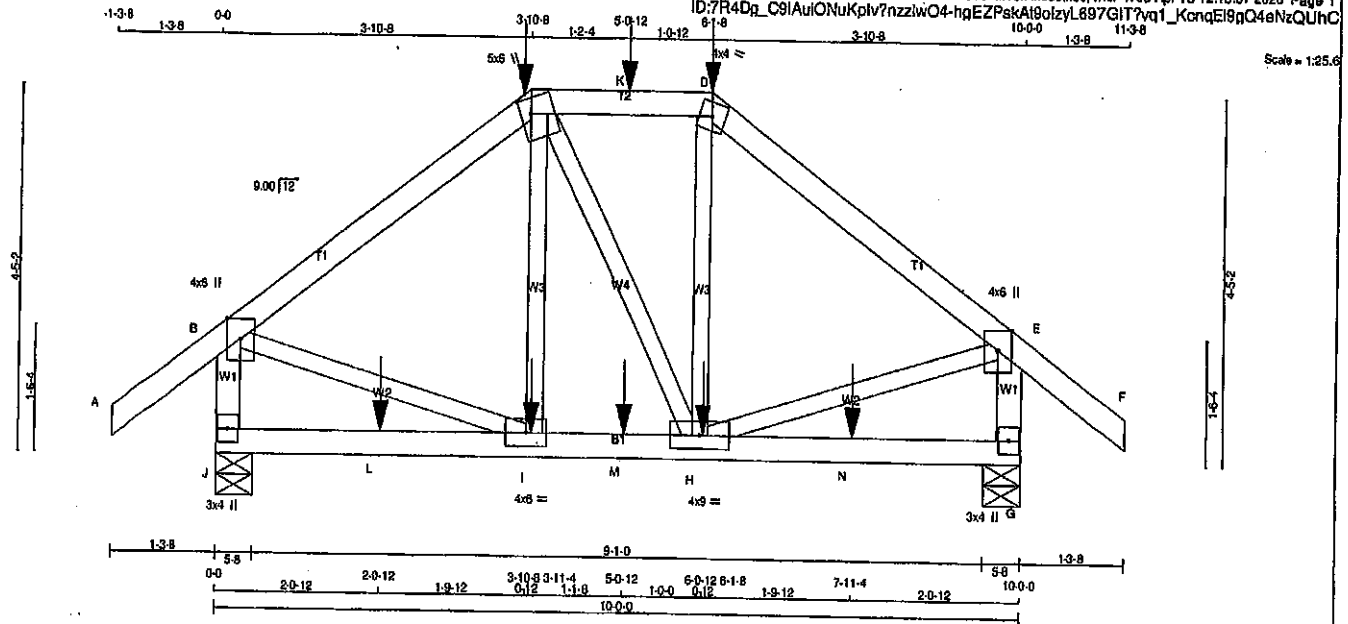

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
J - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
J - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY, SEASONED LUMBER.			

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW+p	MT20	4.0	8.0 Edge
C	TTWW+m	MT20	5.0	8.0 2.25 1.50
D	TTW-m	MT20	4.0	4.0
E	TMVW+p	MT20	4.0	8.0 Edge
G	BMVW+p	MT20	3.0	4.0
H	BMVW+H	MT20	4.0	9.0
I	BMVW+H	MT20	4.0	8.0
J	BMVW+p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	VERT	HORZ	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
J	1058	0	1058	0	0	5.8	5.8	5.8	5.8
G	1058	0	1058	0	0	5.8	5.8	5.8	5.8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	743	509 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0
G	744	510 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.23 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (LBS)	MAX. CSI (LC)	MEMB.	MAX. FORCE (LBS)	MAX. CSI (LC)	MAX. CSI (LC)
FR-TO		FROM	TO	FR-TO			
A-B	0 / 38	-91.8	-91.8 0.14 (1)	10.00	I-C	-105 / 44	0.03 (1)
B-C	-847 / 0	-91.8	-91.8 0.28 (1)	6.23	C-H	0 / 2	0.00 (4)
C-K	-874 / 0	-91.8	-91.8 0.17 (1)	6.25	H-D	-108 / 45	0.03 (1)
K-D	-874 / 0	-91.8	-91.8 0.17 (1)	6.25	D-I	0 / 706	0.17 (1)
D-E	-848 / 0	-91.8	-91.8 0.28 (1)	6.23	H-E	0 / 707	0.17 (1)
E-F	0 / 38	-91.8	-91.8 0.14 (1)	10.00			
J-B	-1018 / 0	0.0	0.0 0.12 (1)	7.74			
G-E	-1018 / 0	0.0	0.0 0.12 (1)	7.74			
J-L	0 / 0	-18.5	-18.5 0.10 (4)	10.00			
L-I	0 / 0	-18.5	-18.5 0.10 (4)	10.00			
I-M	0 / 674	-18.5	-18.5 0.18 (1)	10.00			
M-H	0 / 674	-18.5	-18.5 0.18 (1)	10.00			
H-N	0 / 0	-18.5	-18.5 0.10 (4)	10.00			
N-G	0 / 0	-18.5	-18.5 0.10 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LOC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	3-10-8	-293	-293	---	BACK	VERT	TOTAL	---	C1
D	6-1-8	-293	-293	---	BACK	VERT	TOTAL	---	C1
H	6-0-12	-17	-17	---	BACK	VERT	TOTAL	---	C1
I	3-11-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
K	6-0-12	-88	-88	---	BACK	VERT	TOTAL	---	C1
L	2-0-12	-17	-17	---	BACK	VERT	TOTAL	---	C1
M	5-0-12	-17	-17	---	BACK	VERT	TOTAL	---	C1
N	7-11-4	-17	-17	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 47 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCG 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.33')
CALCULATED VERT. DEFL.(LL) = L/999 (0.01')
ALLOWABLE DEFL.(TL) = L/360 (0.33')
CALCULATED VERT. DEFL.(TL) = L/999 (0.02')

CSI: TC=0.28/1.00 (D-E:1), BC=0.18/1.00 (H-I:1), WB=0.17/1.00 (E-H:1), SS=0.13/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1886

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.71 (E) (INPUT = 0.90)
JSI METAL = 0.46 (E) (INPUT = 1.00)

Structural component only
DWG# T-2006194

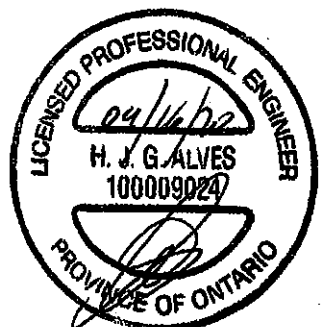

JOB NAME 408158	TRUSS NAME T21	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 15:04:47 2020 Page 1
ID:7R4Dg_C9IAuIOuKpIv7nzzlwO4_So2sX1B0d63Etwn7WekFr5uR93Z6PIUCX56zQSAK
13-0-0

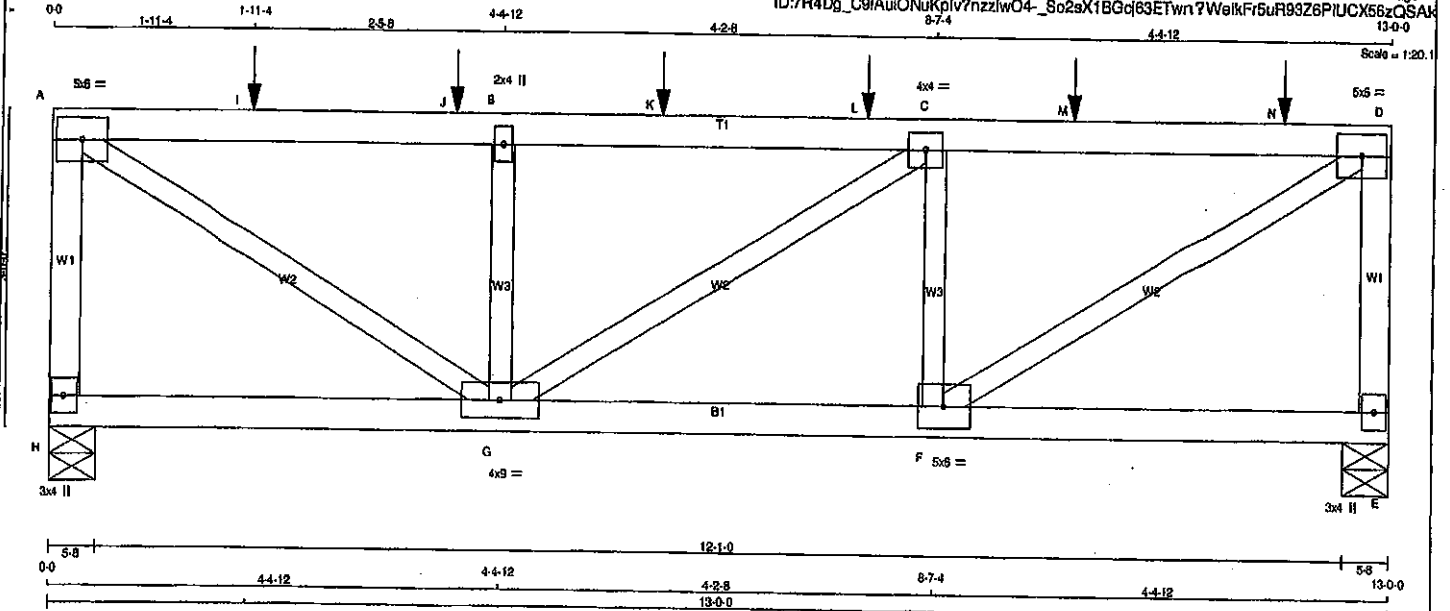

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
H - A	2x4	DRY	No. 2	SPF	
A - D	2x4	DRY	No. 2	SPF	
E - D	2x4	DRY	No. 2	SPF	
H - E	2x4	DRY	No. 2	SPF	

ALL WEBS 2x3 DRY No. 2
DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
H-A 1 12	TOP	
A-D 1 12	SIDE(0.0)	
D-E 1 12	TOP	
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
H-E 1 12	SIDE(21.0)	
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMW4	MT20	5.0	8.0	
B	TMW4	MT20	2.0	4.0	
C	TMW4	MT20	4.0	4.0	
D	TMW4	MT20	5.0	8.0	
E	BMV1p	MT20	3.0	4.0	
F	BMV4	MT20	5.0	8.0	
G	BMVWW4	MT20	4.0	8.0	
H	BMV1p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORIZ	DOWN	HORIZ
H	2173	0	2173	0
E	2348	0	2348	0

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS	DEAD	SOIL
JT COMBINED	SNOW	LIVE	PERM. LIVE
H	1557	908 / 0	0 / 0
E	1680	983 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS H, E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.83 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
H-A	-2084 / 0	0.0	0.0 0.17 (1)	F-D	0 / 3259
A-I	-2748 / 0	-91.8	-91.8 0.46 (1)	A-G	0 / 3226
I-J	-2748 / 0	-91.8	-91.8 0.46 (1)	F-C	-1452 / 0
J-B	-2748 / 0	-91.8	-91.8 0.46 (1)	G-B	-1421 / 0
B-K	-2748 / 0	-91.8	-91.8 0.46 (1)	G-C	-34 / 0
K-L	-2748 / 0	-91.8	-91.8 0.46 (1)		
L-C	-2748 / 0	-91.8	-91.8 0.46 (1)		
C-M	-2775 / 0	-91.8	-91.8 0.46 (1)		
M-N	-2775 / 0	-91.8	-91.8 0.46 (1)		
N-D	-2775 / 0	-91.8	-91.8 0.46 (1)		
E-D	-2240 / 0	0.0	0.0 0.18 (1)		
H-G	0 / 0	-56.0	-56.0 0.12 (4)		
G-F	0 / 2775	-56.0	-56.0 0.30 (1)		
F-E	0 / 0	-56.0	-56.0 0.12 (4)		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	BEEL	CONN.
I	1-11-4	-433	-433	---	BACK	VERT	TOTAL		
J	3-11-4	-433	-433	---	BACK	VERT	TOTAL		
K	5-11-4	-433	-433	---	BACK	VERT	TOTAL		
L	7-11-4	-433	-433	---	BACK	VERT	TOTAL		
M	9-11-4	-433	-433	---	BACK	VERT	TOTAL		
N	11-11-4	-433	-433	---	BACK	VERT	TOTAL		

CONNECTION REQUIREMENTS

1) G1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.43")
CALCULATED VERT. DEFL. (LL) = L/999 (0.04")
ALLOWABLE DEFL. (TL) = L/360 (0.43")
CALCULATED VERT. DEFL. (TL) = L/999 (0.07")

CSI: TC=0.48/1.00 (C-D:1), BC=0.30/1.00 (F-G:1),
WB=0.40/1.00 (D-F:1), SSI=0.39/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PS)	SECTION (PL)
	MAX MIN	MAX MIN
MT20	618 354	1687 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.86 (G) (INPUT = 0.90)
JSI METAL= 0.95 (G) (INPUT = 1.00)

Structural component only
DWG# T-2006199

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408158	T22	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Wed Apr 15 15:04:48 2020 Page 1
ID:7R4Dg_C9IAuONuKpIv7nzzlwO4-SIMR31tp1wryhO26Lj1tFyo7OloGoc3VYz6x5dYzQSA

Scale = 1:23.4

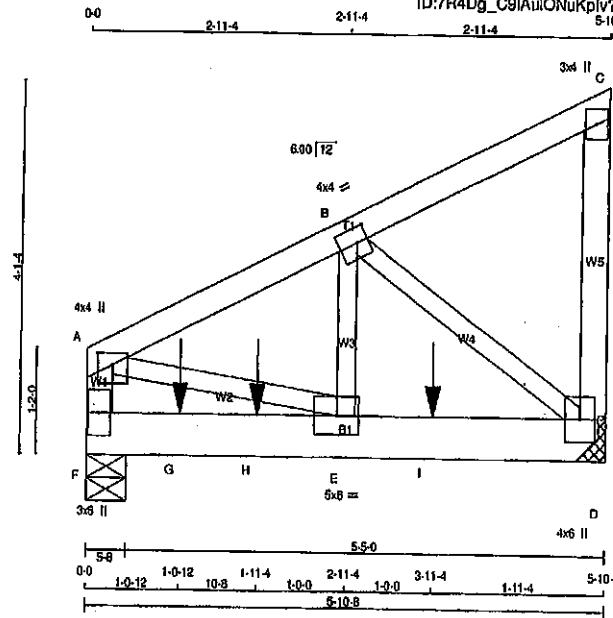

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES	A - G	2x4	DRY	No.2	SPF
	D - C	2x4	DRY	No.2	SPF
	F - A	2x4	DRY	No.2	SPF
	F - D	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
C - D	12	TOP
F - A	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
F - D	12	SIDE (0.0)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.50	2.00
B	TMVW-i	MT20	4.0	4.0	2.00	1.50
C	TMV+p	MT20	3.0	4.0		
D	BMVW1+p	MT20	4.0	6.0		
E	BMVW4	MT20	5.0	6.0		
F	BMV1+p	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
D	1303	1303	0	0
F	1517	1517	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4.0.

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	919	618/0	0/0	0/0	0/0	0/0	304/0	0/0
F	1089	721/0	0/0	0/0	0/0	0/0	348/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	-1491/0	-91.8 -91.8 0.06 (1)	E-B	0/1381
B-C	-10/0	-91.8 -91.8 0.05 (1)	B-D	-1689/0
D-C	-112/0	0.0 0.0 0.01 (1)	A-E	0/1388
F-A	-1137/0	0.0 0.0 0.06 (1)		
F-G	0/0	-18.5 -18.5 0.22 (1)		
G-H	0/0	-18.5 -18.5 0.22 (1)		
H-E	0/0	-18.5 -18.5 0.22 (1)		
E-I	0/1342	-18.5 -18.5 0.24 (1)		
I-D	0/1342	-18.5 -18.5 0.24 (1)		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	1-0-12	-113	-113	---	TOP	VERT	TOTAL	---	C1
H	1-11-4	-1237	-1237	---	BACK	VERT	TOTAL	---	C1
I	3-11-4	-822	-822	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

TOTAL WEIGHT = 2 X 29 = 58 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (0.20")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.01")
ALLOWABLE DEFL.(TL) = 1/360 (0.20")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.02")

CSI: TC=0.08/1.00 (A-F:1), BC=0.24/1.00 (D-E:1),
WB=0.20/1.00 (B-D:1), SSI=0.34/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MT20	618	354	1667
			788
			1987
			1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.04 (A) (INPUT = 0.00)
JSI METAL = 0.30 (D) (INPUT = 1.00)



Structural component only
DWG# T-2006200


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408158	T23S	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310.5 Oct 29 2019 Mittek Industries, Inc. Wed Apr 15 15:04:49 2020 Page 2
ID:7R4Dg C9IAuIONuKplv7nzzwO4-wrvgHD2RoEzoJXdlvQY6n9KC8i7aXW9/Cqhe9 zQSA


FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
T	4-3-12	-8	-8	---	FRONT	VERT	TOTAL	---	C1
U	6-3-12	-8	-8	---	FRONT	VERT	TOTAL	---	C1
V	8-3-12	-8	-8	---	FRONT	VERT	TOTAL	---	C1
W	10-3-12	-8	-8	---	FRONT	VERT	TOTAL	---	C1
X	13-2-12	-15	-15	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

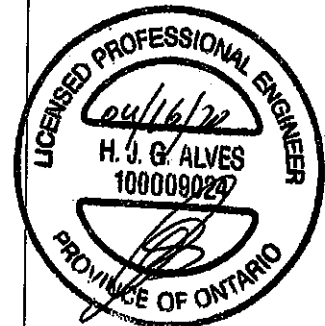

Structural component only
DWG# T-2006201

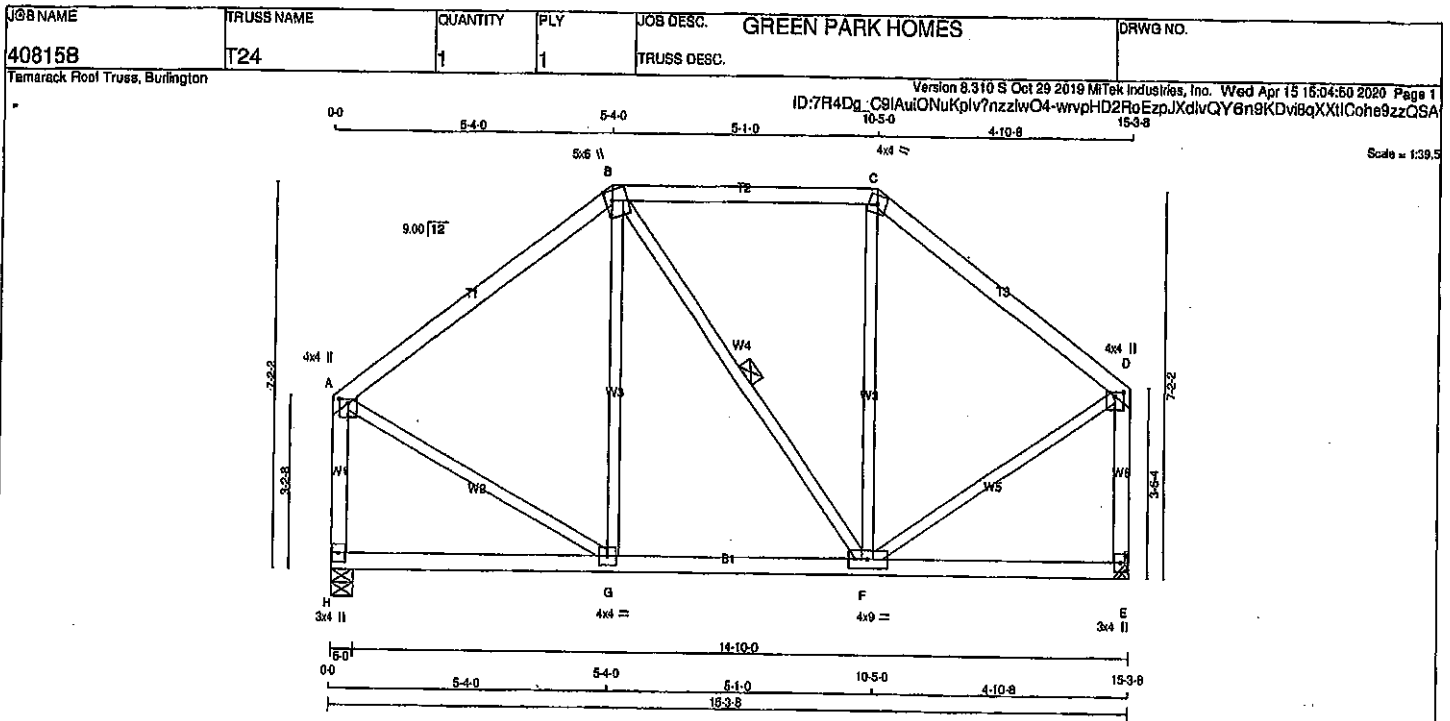

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF
B - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
H - A	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
H - E	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00 2.00
B	TTWV+m	MT20	5.0	6.0	2.25 1.50
C	TTW-m	MT20	4.0	4.0	
D	TMVW+p	MT20	4.0	4.0	1.00 2.00
E	BMV1+p	MT20	3.0	4.0	
F	BMVWV-l	MT20	4.0	9.0	
G	BMVW-l	MT20	4.0	4.0	
H	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	HORZ	UPLIFT
H 841	0	841	0
E 841	0	841	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 3-8.

UNFACTORED REACTIONS

1ST LOOSE	MAX/MIN. COMPONENT REACTIONS
JT COMBINED	SNOW
H 595	390 / 0
E 595	390 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF B-F.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	CHORDS		WEBS	
		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)
FR-TO					
A-B	-542 / 0	-91.8	-91.8	0.33 (1)	6.25
B-C	-413 / 0	-91.8	-91.8	0.30 (1)	6.25
C-D	-520 / 0	-91.8	-91.8	0.28 (1)	6.25
H-A	-800 / 0	0.0	0.0	0.14 (1)	7.81
E-D	-803 / 0	0.0	0.0	0.17 (1)	7.81
H-G	0 / 0	-18.5	-18.5	0.12 (4)	10.00
G-F	0 / 431	-18.5	-18.5	0.15 (4)	10.00
F-E	0 / 0	-18.5	-18.5	0.10 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(56% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.51")

CALCULATED VERT. DEFL.(LL) = L/999 (0.01")

ALLOWABLE DEFL.(TL) = L/360 (0.51")

CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.33/1.00 (A-B:1), BC=0.16/1.00 (F-G:4), WB=0.12/1.00 (C-F:1), SS=0.18/1.00 (8-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	818	354
	1987	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


SI GRIP = 0.69 (A) (INPUT = 0.90)

SI METAL = 0.18 (A) (INPUT = 1.00)

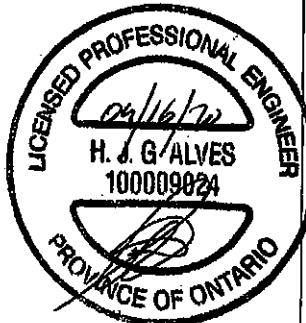

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408159	T31	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Wed Apr 15 12:51:43 2020 Page 1	

ID: MTW7E0QKRW7Mm2IBLF7kizax7-ITMmBXP6WpxDG6S4DHN64aQRUVSP6EgKA3stzQU7U
 1-3-8 0-0 5-10-8 5-10-8 5-1-2 10-11-10 4-11-14 15-11-8 4-11-14 20-11-6 5-1-2 28-0-8 5-10-8 31-11-0 33-2-8
 Scale = 1:52.6

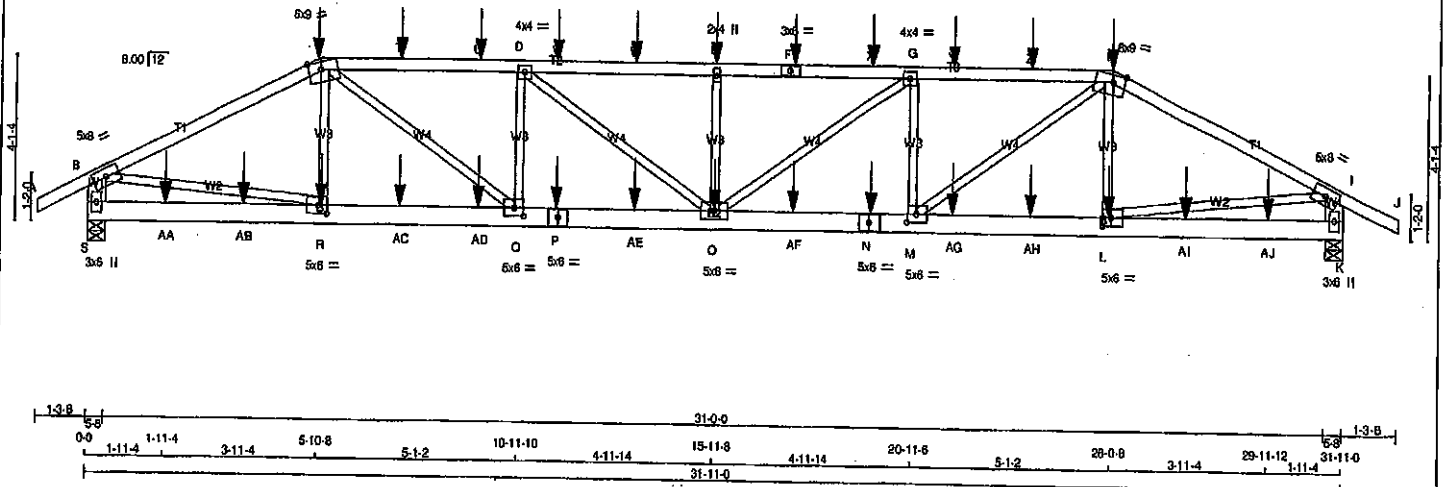

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
S - B	2x6	DRY	No.2	SPF	
K - I	2x6	DRY	No.2	SPF	
S - P	2x6	DRY	1650F 1.5E	SPF	
P - N	2x6	DRY	1650F 1.5E	SPF	
N - K	2x6	DRY	1650F 1.5E	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C 1	12	SIDE (61.0)
C-F 1	12	SIDE (61.0)
F-H 1	12	SIDE (61.0)
H-J 1	12	SIDE (61.0)
S-B 2	12	TOP
K-I 2	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
S-P 2	12	SIDE (183.1)
P-N 2	12	SIDE (183.1)
N-K 2	12	SIDE (183.1)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMWV-1	MT20	5.0	8.0		
C	TTWV-m	MT20	6.0	9.0	2.25	3.75
D	TMWV-1	MT20	4.0	4.0		
E	TMWV-w	MT20	2.0	4.0		
F	TS-1	MT20	3.0	6.0		
G	TMWV-1	MT20	4.0	4.0		
H	TTWV-m	MT20	6.0	9.0	2.25	3.75
I	TMWV-1	MT20	5.0	6.0		
K	BMV1-p	MT20	3.0	6.0		
L	BMWV-1	MT20	6.0	8.0	2.50	2.50
M	BMWV-1	MT20	5.0	6.0	2.50	2.75
N	BS-1	MT20	5.0	8.0		
O	BMWV-1	MT20	5.0	8.0		
P	BS-1	MT20	5.0	8.0		
Q	BMWV-1	MT20	5.0	6.0	2.50	2.75
R	BMWV-1	MT20	5.0	8.0	2.50	2.50
S	BMV1-p	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
S	2988	0	2988	0
K	2988	0	2988	0

UNFACTORED REACTIONS	1ST LCASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
S	2114	1385 / 0
K	2114	1384 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.43 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING	CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
TOTAL LOAD CASES: (4)	MEMB.	FORCE (LBS)	VERT. LOAD LC1 MAX (PLF)	MEMB.	FORCE (LBS)
	FR-TO		FROM TO	FR-TO	
	A-B	0 / 28	-91.8	-91.8	0.07 (1)
	B-C	-4481 / 0	-91.8	-91.8	0.48 (1)
	C-T	-5884 / 0	-91.8	-91.8	0.48 (1)
	T-U	-5884 / 0	-91.8	-91.8	0.48 (1)
	U-D	-5884 / 0	-91.8	-91.8	0.48 (1)
	D-V	-8424 / 0	-91.8	-91.8	0.52 (1)
	V-W	-8424 / 0	-91.8	-91.8	0.52 (1)
	W-E	-8424 / 0	-91.8	-91.8	0.52 (1)
	E-F	-8424 / 0	-91.8	-91.8	0.51 (1)
	F-X	-8424 / 0	-91.8	-91.8	0.51 (1)
	X-G	-8424 / 0	-91.8	-91.8	0.51 (1)
	G-Y	-5881 / 0	-91.8	-91.8	0.48 (1)
	Y-Z	-5881 / 0	-91.8	-91.8	0.48 (1)
	Z-H	-5881 / 0	-91.8	-91.8	0.48 (1)
	H-I	-4459 / 0	-91.8	-91.8	0.48 (1)
	I-J	0 / 28	-91.8	-91.8	0.07 (1)
	S-B	-2910 / 0	0.0	0.0	0.10 (1)
	K-I	-2809 / 0	0.0	0.0	0.10 (1)

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-411	-411			FRONT	VERT	TOTAL		C1
E	15-11-8	-110	-110			FRONT	VERT	TOTAL		C1
F	17-11-12	-110	-110			FRONT	VERT	TOTAL		C1

TOTAL WEIGHT = 2 X 143 = 286 lb

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCS 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBCS 2010, NBCS 2015
 - PART 9 OF NBCS 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.17")
 ALLOWABLE DEFL.(TL) = L/360 (1.06")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.32")

CSI: TC=0.52/1.00 (D-E:1), BC=0.28/1.00 (C-Q:1), WB=0.50/1.00 (B-R:1), SSI=0.19/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PS) (PLI) (PLI)
 MAX MIN MAX MIN
 MT20 618 354 1897 788 1897 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.73 (L) (INPUT = 0.90)
 JSI METAL = 0.65 (N) (INPUT = 1.00)



Structural component only
 DWG# T-2006212

CONTINUED ON PAGE 2


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408159	T31	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 12:51:43 2020 Page 2
 ID:MTW7E0QKeRW7Mm2fBLF7Kizsx7-ITMmBXP6WVXoxDG6S4DHN64aQRUVSPe6EqKA3stzQU7U

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
H	28-0-8	-411	-411	---	FRONT	VERT	TOTAL	---	C1
L	25-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
N	19-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
O	15-11-8	-26	-26	---	FRONT	VERT	TOTAL	---	C1
P	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	8-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	19-11-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	21-11-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	23-11-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AB	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AC	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AD	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AE	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	17-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	21-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	23-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	27-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	29-11-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

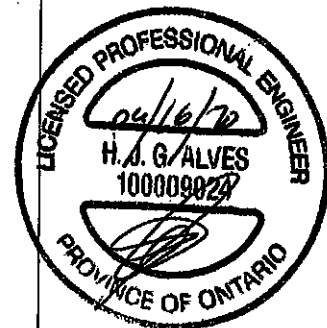

Structural component only
 DWG# T-2006212

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408159	T31Z	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 12:51:45 2020 Page 1					
ID:MTW7E0QKRW7Mm2IBLF7kzlsx7-IsUXcQM283fS2GBeJrCVkel5VWGXHaf9xizQU7S					
31-11-0 33-2-8 1-3-8					
Scale = 1:52.6					

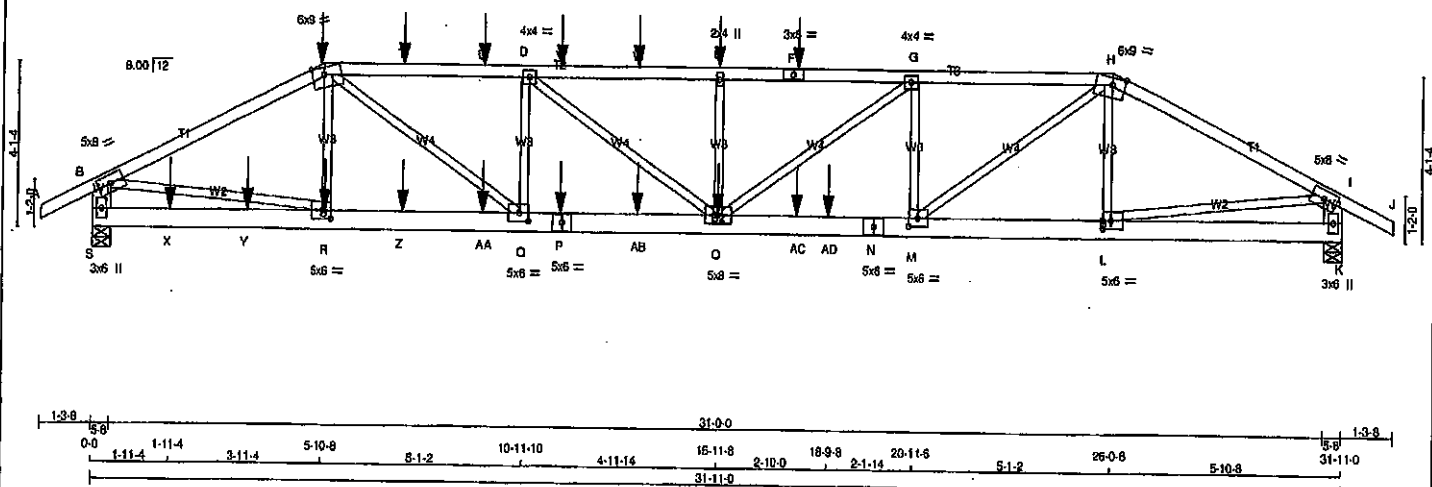

LUMBER	SIZE	DRY	NO.2	DESCR.
N. L. G. A. RULES				
CHORDS				
A - C	2x4	DRY	No.2	SPF
C - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF
J - L	2x4	DRY	No.2	SPF
K - I	2x6	DRY	No.2	SPF
S - P	2x6	DRY	No.2	SPF
P - N	2x6	DRY	No.2	SPF
N - K	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C 1	12	SIDE (61.0)
C-F 1	12	SIDE (61.0)
F-H 1	12	TOP (0.0)
H-J 1	12	TOP
J-L 1	12	TOP
K-I 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S-P 2	12	SIDE (183.1)
P-N 2	12	SIDE (183.1)
N-K 2	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE PLATES				
B TMWV-1 MT20	5.0	8.0		
C TTMWV-m MT20	6.0	9.0	2.25	3.75
D TMWV-1 MT20	4.0	4.0		
E TMWV-1 MT20	2.0	4.0		
F TS-1 MT20	3.0	6.0		
G TMWV-1 MT20	4.0	4.0		
H TTMWV-m MT20	6.0	9.0	2.25	3.75
I TMWV-1 MT20	5.0	8.0		
K BMWV-1 MT20	3.0	6.0		
L BMWV-1 MT20	5.0	8.0	2.50	2.50
M BMWV-1 MT20	5.0	8.0	2.50	2.75
N BS-1 MT20	5.0	8.0		
O BMWV-1 MT20	5.0	8.0		
P BS-1 MT20	5.0	8.0		
Q BMWV-1 MT20	5.0	6.0	2.50	2.75
R BMWV-1 MT20	5.0	6.0	2.50	2.50
S BMV1-p MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	3419	3419	0	5-8
S VERT	3223	3223	0	5-8
K VERT	3223	3223	0	5-8

UNFACTORED REACTIONS	1ST LCASE	MAX MIN. COMPONENT REACTIONS
JT COMBINED	SNOW	LIVE
S COMBINED	SNOW	LIVE
K COMBINED	SNOW	LIVE

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K


BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.89 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 MAX (PLF)	OSI (LC)	UNBRACED LENGTH FR-TO	WEBS	MAX. FACTORED FORCE (LBS)	MAX. OSI (LC)
FR-TO					FR-TO		
A-B	0/28	-91.8	-91.8	0.07 (1)	10.00	R-C	-385 / 27
B-C	-9228 / 0	-91.8	-91.8	0.53 (1)	3.81	C-D	0 / 3091
C-D	-7110 / 0	-91.8	-91.8	0.57 (1)	3.23	D-E	-1783 / 0
D-E	-7110 / 0	-91.8	-91.8	0.57 (1)	3.23	E-F	0 / 1599
E-F	-7110 / 0	-91.8	-91.8	0.57 (1)	3.23	F-G	-681 / 0
F-G	-8391 / 0	-91.8	-91.8	0.58 (1)	2.89	G-H	0 / 1080
G-H	-8391 / 0	-91.8	-91.8	0.58 (1)	2.89	H-I	-1160 / 0
H-I	-8391 / 0	-91.8	-91.8	0.58 (1)	2.89	I-J	0 / 3982
I-J	-8391 / 0	-91.8	-91.8	0.58 (1)	3.05	J-K	-821 / 0
J-K	-8391 / 0	-91.8	-91.8	0.53 (1)	3.05	K-L	0 / 4713
K-L	-7542 / 0	-91.8	-91.8	0.47 (1)	3.27	L-M	0 / 4398
L-M	-4877 / 0	-91.8	-91.8	0.61 (1)	3.94	M-N	0 / 4398
M-N	0 / 28	-91.8	-91.8	0.07 (1)	10.00	N-O	0 / 4398
N-O	-3343 / 0	0.0	0.0	0.12 (1)	7.61	O-P	0 / 4398
O-P	-3145 / 0	0.0	0.0	0.11 (1)	7.78	P-Q	0 / 4398
P-Q	0 / 0	-18.5	-18.5	0.04 (4)	10.00	Q-R	0 / 4398
Q-R	0 / 0	-18.5	-18.5	0.04 (4)	10.00	R-S	0 / 4398
R-S	0 / 4683	-18.5	-18.5	0.24 (1)	10.00	S-T	0 / 4683
S-T	0 / 4683	-18.5	-18.5	0.24 (1)	10.00	T-U	0 / 4683
T-U	0 / 4683	-18.5	-18.5	0.24 (1)	10.00	U-V	0 / 4683
U-V	0 / 7110	-18.5	-18.5	0.39 (1)	10.00	V-W	0 / 7110
V-W	0 / 7110	-18.5	-18.5	0.39 (1)	10.00	W-X	0 / 7110
W-X	0 / 7542	-18.5	-18.5	0.69 (1)	10.00	X-Y	0 / 7542
X-Y	0 / 7542	-18.5	-18.5	0.69 (1)	10.00	Y-Z	0 / 7542
Y-Z	0 / 7542	-18.5	-18.5	0.69 (1)	10.00	Z-AA	0 / 7542
Z-AA	0 / 7542	-18.5	-18.5	0.69 (1)	10.00	AA-Q	0 / 7542
AA-Q	0 / 7542	-18.5	-18.5	0.69 (1)	10.00	Q-P	0 / 7542
Q-P	0 / 4342	-18.5	-18.5	0.31 (1)	10.00	P-A	0 / 4342
P-A	0 / 0	-18.5	-18.5	0.04 (1)	10.00	A-B	0 / 0

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
JT	5-10-8	-411	-411	---	---	BACK	VERT	TOTAL	---	C1
C	15-11-8	-110	-110	---	---	BACK	VERT	TOTAL	---	C1
E	17-11-12	-110	-110	---	---	BACK	VERT	TOTAL	---	C1
O	15-11-8	-28	-28	---	---	BACK	VERT	TOTAL	---	C1
P	11-11-4	-28	-28	---	---	BACK	VERT	TOTAL	---	C1
R	5-11-4	-28	-28	---	---	BACK	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	---	BACK	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	---	BACK	VERT	TOTAL	---	C1
V	11-11-4	-110	-110	---	---	BACK	VERT	TOTAL	---	C1

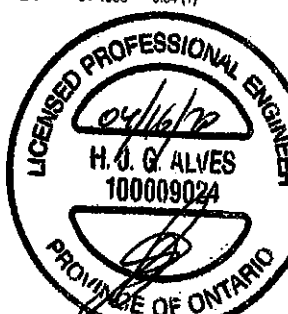

TOTAL WEIGHT = 2 X 143 = 286 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIG 2011, TPIG 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEF. (LL) = L/360 (1.08")
CALCULATED VERT. DEF. (LL) = L/999 (0.25")
ALLOWABLE DEF. (TL) = L/360 (1.08")
CALCULATED VERT. DEF. (TL) = L/852 (0.46")

CSI: TC=0.69/1.00 (D-E:1), BC=0.69/1.00 (M-O:1), WB=0.58/1.00 (B-R:1), SS=0.32/1.00 (M-O:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLF) (PLI)
MT20 918 354 1507 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.87 (N) (INPUT = 0.90)
JSI METAL = 0.85 (N) (INPUT = 1.00)

Structural component only 1/2
DWG# T-2006213

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408159	T31Z	1	2	TRUSS DESC.		


Tamarack Floor Truss, Burlington

Version 8.910 S Oct 29 2019 MITek Industries, Inc. Wed Apr 15 12:51:45 2020 Page 2
ID:MTW7E0OKeRW7Mm2IBLF7kizlax7-lsUXcCQM283fSZGfBoJrCVfkel5VWGXHeI9xtzQU7S

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LO1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
W	13-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
X	1-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
Y	3-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
Z	7-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AA	9-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AB	13-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AC	17-11-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AD	18-9-8	-1564	-1564	---	BACK	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

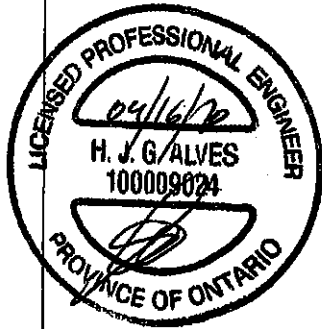

Structural component only
DWG# T-2008213

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408159	T32	2	1	GREEN PARK HOMES	
Tamarack Pool Truss, Burlington					
Version 8.310 S Oct 28 2019 MITek Industries, Inc. Wed Apr 15 12:51:48 2020 Page 1					
ID:MTW7E0QKerW7Mm2IBLF?kzlsx7-A22vqYR_pSBW4r1Mq4kiCxiTKow2gWIPITCzQU7R					
187.7 167.7 5-5-1 13-3-9 5-3-13 5-5-1 24-0-8 3-10-0 27-10-8 4-0-8 31-11-0 33-2-8 1-3-8					
Scale = 1:52.6					

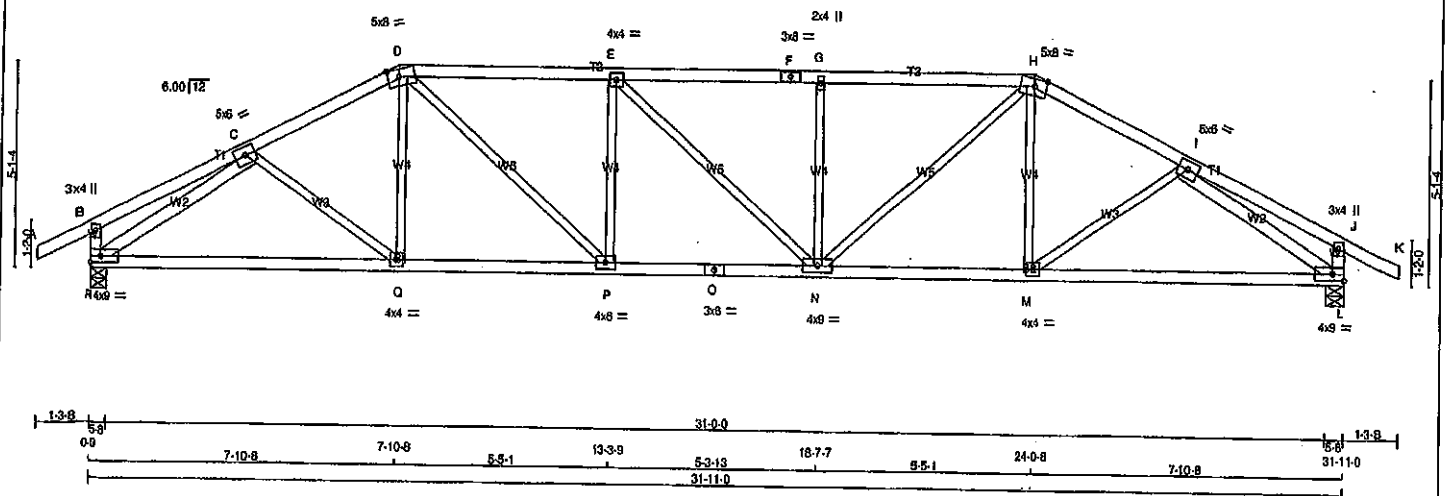

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - F	2x4	DRY	No.2	SPF		
F - H	2x4	DRY	No.2	SPF		
H - K	2x4	DRY	No.2	SPF		
R - B	2x4	DRY	No.2	SPF		
L - J	2x4	DRY	No.2	SPF		
R - O	2x4	DRY	No.2	SPF		
O - L	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						
R - C	2x4	DRY	No.2	SPF		
I - L	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVap	MT20	3.0	4.0		
C	TMWw-t	MT20	5.0	6.0		
D	TTWW-m	MT20	5.0	8.0	2.25	3.50
E	TMWw-t	MT20	4.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMWw	MT20	2.0	4.0		
H	TTWW-m	MT20	5.0	8.0	2.25	3.50
I	TMWw-t	MT20	5.0	6.0		
J	TMVap	MT20	3.0	4.0		
L	BMVW-t	MT20	4.0	9.0		Edge
M	BMVW-t	MT20	4.0	4.0		
N	BMVWw-t	MT20	4.0	9.0		
O	BS-t	MT20	3.0	8.0		
P	BMVW-t	MT20	4.0	6.0		
Q	BMVW-t	MT20	4.0	4.0		
R	BMVW-t	MT20	4.0	9.0		Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
R	1884	0	1884	0
L	1884	0	1884	0

UNFACTORED REACTIONS

	1ST LOASE	MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1330	886 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0
L	1330	886 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.61 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-81.8	-81.8	0.12 (1)	10.00	C-Q	0 / 74
B-C	0 / 17	-81.8	-81.8	0.20 (1)	10.00	Q-D	0 / 133
C-D	-2469 / 0	-81.8	-81.8	0.30 (1)	4.12	D-P	0 / 933
D-E	-2891 / 0	-81.8	-81.8	0.54 (1)	3.81	P-E	-534 / 0
E-F	-2891 / 0	-81.8	-81.8	0.53 (1)	3.81	E-N	-2 / 0
F-G	-2891 / 0	-81.8	-81.8	0.53 (1)	3.81	N-H	0 / 931
G-H	-2891 / 0	-81.8	-81.8	0.30 (1)	4.12	H-I	-533 / 0
H-I	-2469 / 0	-81.8	-81.8	0.20 (1)	10.00	I-J	0 / 134
I-J	0 / 17	-81.8	-81.8	0.12 (1)	10.00	M-I	0 / 74
J-K	0 / 28	-81.8	-81.8	0.20 (1)	10.00	R-C	-2888 / 0
R-B	-268 / 0	0.0	0.0	0.03 (1)	7.81	I-L	-2887 / 0
L-J	-268 / 0	0.0	0.0	0.03 (1)	7.81		
R-Q	0 / 2167	-18.5	-18.5	0.49 (1)	10.00		
Q-P	0 / 2194	-18.5	-18.5	0.48 (1)	10.00		
P-O	0 / 2893	-18.5	-18.5	0.53 (1)	10.00		
O-N	0 / 2893	-18.5	-18.5	0.53 (1)	10.00		
N-M	0 / 2194	-18.5	-18.5	0.49 (1)	10.00		
M-L	0 / 2168	-18.5	-18.5	0.49 (1)	10.00		

TOTAL WEIGHT = 2 X 130 = 260 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.06")
CALCULATED VERT. DEFL.(LL) = $L/889$ (0.15")
ALLOWABLE DEFL.(TL) = $L/360$ (1.06")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.28")

CSI: TC=0.54/1.00 (D-E:1), BC=0.53/1.00 (N-P:1), WB=0.74/1.00 (I-L:1), SS=0.23/1.00 (O-E:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	818	354	1887
	788	1887	1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

SI GRIP= 0.84 (O) (INPUT = 0.80)
SI METAL= 0.94 (O) (INPUT = 1.00)

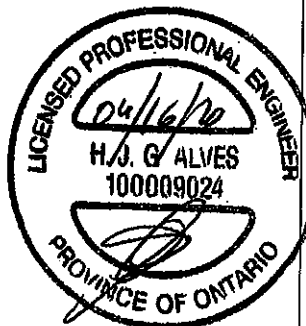

Structural component only
DWG# T-2006214

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Wed Apr 15 12:51:47 2020 Page 1
ID:MTW7E0QKeRW7Mm2IBLF7kizix7-eEcH1uScamJNtQD3JLHw666r2LQjpy8G0eZQU7Q
-1-3-8 0-0 5-0-8 5-0-8 4-10-0 9-10-8 6-1-0 15-11-8 22-0-8 6-1-0 4-10-0 28-10-8 31-11-0 33-2-8 50-6 1-3-8
Scale = 1:82.6

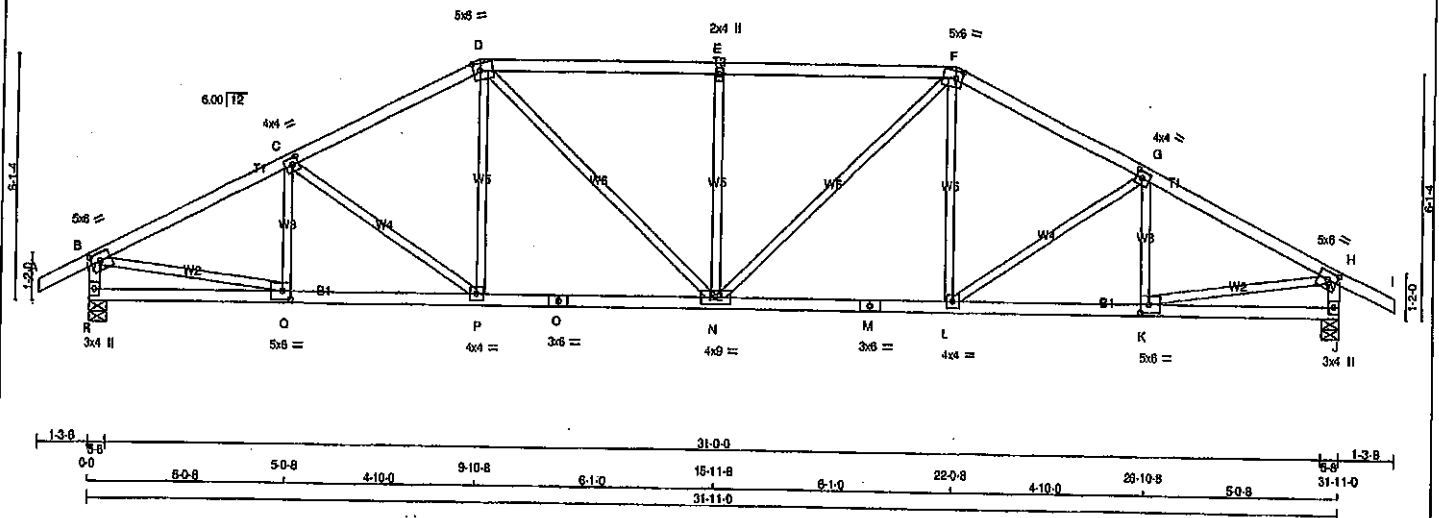

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
			SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)					
J	TYPE	PLATES	W	LEN	Y
B	TMWW-I	MT20	5.0	6.0	2.25
C	TMWW-I	MT20	4.0	2.00	1.75
D	TMWW-m	MT20	6.0	6.0	2.25
E	TMWW-w	MT20	2.0	4.0	
F	TMWW-m	MT20	5.0	6.0	2.25
G	TMWW-I	MT20	4.0	2.00	1.75
H	TMWW-I	MT20	5.0	6.0	2.25
I	BMV1-p	MT20	3.0	4.0	
J	BMWW-I	MT20	5.0	6.0	2.50
K	BMWW-I	MT20	4.0	4.0	
L	BS-I	MT20	3.0	6.0	
M	BMWWWW-I	MT20	4.0	9.0	
N	BS-I	MT20	3.0	6.0	
O	BMWW-I	MT20	4.0	4.0	
P	BMWW-I	MT20	5.0	8.0	2.50
Q	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQ'D
		GROSS REACTION		GROSS REACTION		BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
R	1884	0	1884	0	0	5-8	5-8
J	1884	0	1884	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1330	888 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0
J	1330	888 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B. J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.82 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBB			
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LOAD LCI (CSI (LC))	MAX. UNBRAC (LC)	MEMB.	MAX. FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO		LENGTH	FR-TO		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	Q-C	-301 / 0 0.07 (1)
B-C	-2538 / 0	-91.8	-91.8	0.37 (1)	4.02	C-P	-264 / 0 0.16 (1)
C-D	-2342 / 0	-91.8	-91.8	0.35 (1)	4.17	P-D	0 / 257 0.08 (1)
D-E	-2493 / 0	-91.8	-91.8	0.54 (1)	3.82	D-N	0 / 575 0.13 (1)
E-F	-2493 / 0	-91.8	-91.8	0.54 (1)	3.82	N-E	-885 / 0 0.40 (1)
F-G	-2342 / 0	-91.8	-91.8	0.35 (1)	4.17	N-F	0 / 575 0.13 (1)
G-H	-2538 / 0	-91.8	-91.8	0.37 (1)	4.02	L-F	0 / 257 0.08 (1)
H-I	0 / 28	-91.8	-91.8	0.12 (1)	10.00	L-G	-264 / 0 0.16 (1)
R-B	-1841 / 0	0.0	0.0	0.19 (1)	6.17	K-G	-301 / 0 0.07 (1)
J-H	-1841 / 0	0.0	0.0	0.19 (1)	6.17	B-Q	0 / 2323 0.52 (1)
						K-H	0 / 2323 0.52 (1)
R-Q	0 / 0	-18.5	-18.5	0.10 (4)	10.00		
Q-P	0 / 2290	-18.5	-18.5	0.43 (1)	10.00		
P-O	0 / 2077	-18.5	-18.5	0.40 (1)	10.00		
O-N	0 / 2077	-18.5	-18.5	0.40 (1)	10.00		
N-M	0 / 2077	-18.5	-18.5	0.40 (1)	10.00		
M-L	0 / 2077	-18.5	-18.5	0.40 (1)	10.00		
L-K	0 / 2290	-18.5	-18.5	0.43 (1)	10.00		
K-J	0 / 0	-18.5	-18.5	0.10 (4)	10.00		

TOTAL WEIGHT = 2 X 120 = 258 lb

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	=	25.6 PSF
	DL	=	8.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.4 PSF
TOTAL LOAD		=	39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.06")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.13")
ALLOWABLE DEFL.(TL) = $L/360$ (1.06")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.24")

CSI: TC=0.54/1.00 (D-E:1), BC=0.43/1.00 (K-L:1),
WB=0.52/1.00 (H-K:1), SSI=0.27/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PL)		(PL)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	618	364	1667	788	1987-1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP=0.90 (B) (INPUT = 0.90)
JSI METAL= 0.67 (B) (INPUT = 1.00)

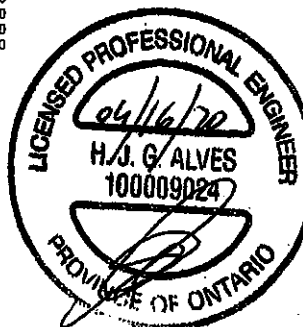

Structural component only
DWG# T-2006215

JOB NAME 408159	TRUSS NAME T34	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Wed Apr 15 12:51:48 2020 Page 1
 ID:MTW7E0QKRW7Mm2IBLF7Kizlsx7-6RAIEETEL3REJ1_QsmeYp7HHhVBE4trz_cuqY4zQU7P
 1-3-8 0-0 6-0-8 8-0-8 11-10-8 11-10-8 4-1-0 15-11-8 4-1-0 20-0-8 5-10-0 25-10-8 31-11-0 33-2-8
 1-3-8 0-0 6-0-8 8-0-8 11-10-8 11-10-8 4-1-0 15-11-8 4-1-0 20-0-8 5-10-0 25-10-8 31-11-0 33-2-8
 Scale = 1:82.6

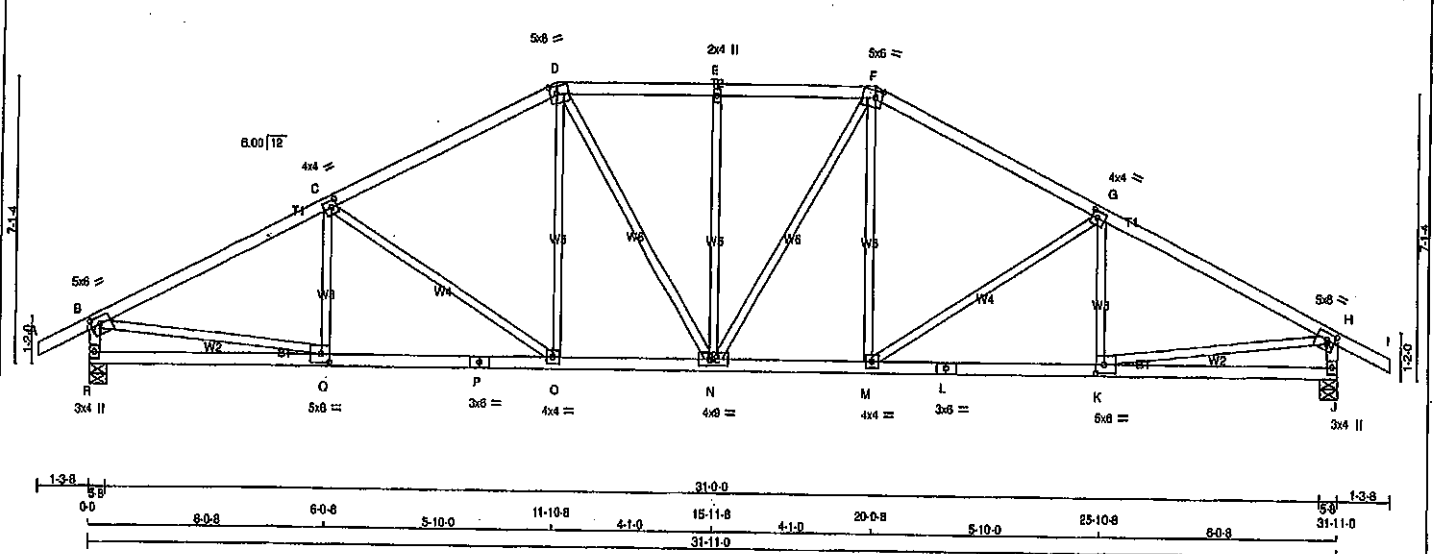

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN Y	X
B TMVW-1	MT20	5.0	6.0	2.00 2.75
C TMVW-1	MT20	4.0	4.0	2.00 1.75
D TTWW-m	MT20	5.0	6.0	2.25 2.00
E TMVW-w	MT20	2.0	4.0	
F TTWW-m	MT20	5.0	6.0	2.25 2.00
G TMVW-1	MT20	4.0	4.0	2.00 1.75
H TMVW-1	MT20	5.0	6.0	2.00 2.75
J BMV1-p	MT20	3.0	4.0	
K BMVW-1	MT20	5.0	6.0	2.50 2.50
L BS-1	MT20	3.0	6.0	
M BMVW-1	MT20	4.0	4.0	
N BMVW-1	MT20	4.0	4.0	
O BMVW-1	MT20	4.0	4.0	
P BS-1	MT20	3.0	6.0	
Q BMVW-1	MT20	5.0	6.0	2.50 2.50
R BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
R	1884	0	1884	0	0	5-8	5-8	5-8	5-8
J	1884	0	1884	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX MIN COMPONENT REACTIONS		PERMANENT		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERMANENT	WIND	DEAD	SOIL	DEAD	SOIL	DEAD	SOIL	DEAD	SOIL
R	1330	886 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0	444 / 0	0 / 0	444 / 0	0 / 0	444 / 0	0 / 0
J	1330	886 / 0	0 / 0	0 / 0	0 / 0	444 / 0	0 / 0	444 / 0	0 / 0	444 / 0	0 / 0	444 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J


BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. CSI (LC)
FR-TO	FROM	TO	LENGTH	FR-TO	FROM	TO	LENGTH
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	C-C	-212 / 29	0.06 (1)
B-C	-2679 / 0	-91.8	-91.8 0.55 (1)	3.79	C-D	-480 / 0	0.46 (1)
C-D	-2188 / 0	-91.8	-91.8 0.49 (1)	4.11	D-E	0 / 382	0.08 (1)
D-E	-2088 / 0	-91.8	-91.8 0.24 (1)	4.49	D-N	0 / 296	0.07 (1)
E-F	-2088 / 0	-91.8	-91.8 0.24 (1)	4.49	E-F	-451 / 0	0.39 (1)
F-G	-2188 / 0	-91.8	-91.8 0.49 (1)	4.11	N-F	0 / 296	0.07 (1)
G-H	-2579 / 0	-91.8	-91.8 0.65 (1)	3.79	M-F	0 / 382	0.08 (1)
H-I	0 / 28	-91.8	-91.8 0.12 (1)	10.00	M-G	-480 / 0	0.46 (1)
R-B	-1836 / 0	0.0	0.0 0.19 (1)	6.18	K-H	-212 / 29	0.06 (1)
J-H	-1836 / 0	0.0	0.0 0.19 (1)	6.18	B-Q	0 / 2356	0.53 (1)
					K-H	0 / 2356	0.53 (1)
R-Q	0 / 0	-18.5	-18.5 0.15 (4)	10.00			
Q-P	0 / 2332	-18.5	-18.5 0.44 (1)	10.00			
P-O	0 / 2332	-18.5	-18.5 0.44 (1)	10.00			
O-N	0 / 1935	-18.5	-18.5 0.37 (1)	10.00			
N-M	0 / 1935	-18.5	-18.5 0.37 (1)	10.00			
M-L	0 / 2332	-18.5	-18.5 0.44 (1)	10.00			
L-K	0 / 2332	-18.5	-18.5 0.44 (1)	10.00			
K-J	0 / 0	-18.5	-18.5 0.15 (4)	10.00			

JOB NAME 408159	TRUSS NAME T35	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 12:51:49 2020 Page 1
 ID:MTW7E0QK9RW7Mm2IBLF?kizlsx?-adk1SaT6NZ5xBZcQUmMLqQqvVmpK38CGdN4WzQU70
 1-3-8 0.0 7-0-8 7-0-8 8-10-0 13-10-8 4-2-0 18-0-8 6-10-0 24-10-8 7-0-8 31-11-0 33-2-8
 1-3-8 0.0 7-0-8 7-0-8 8-10-0 13-10-8 4-2-0 18-0-8 6-10-0 24-10-8 7-0-8 31-11-0 33-2-8
 Scale = 1:53.3

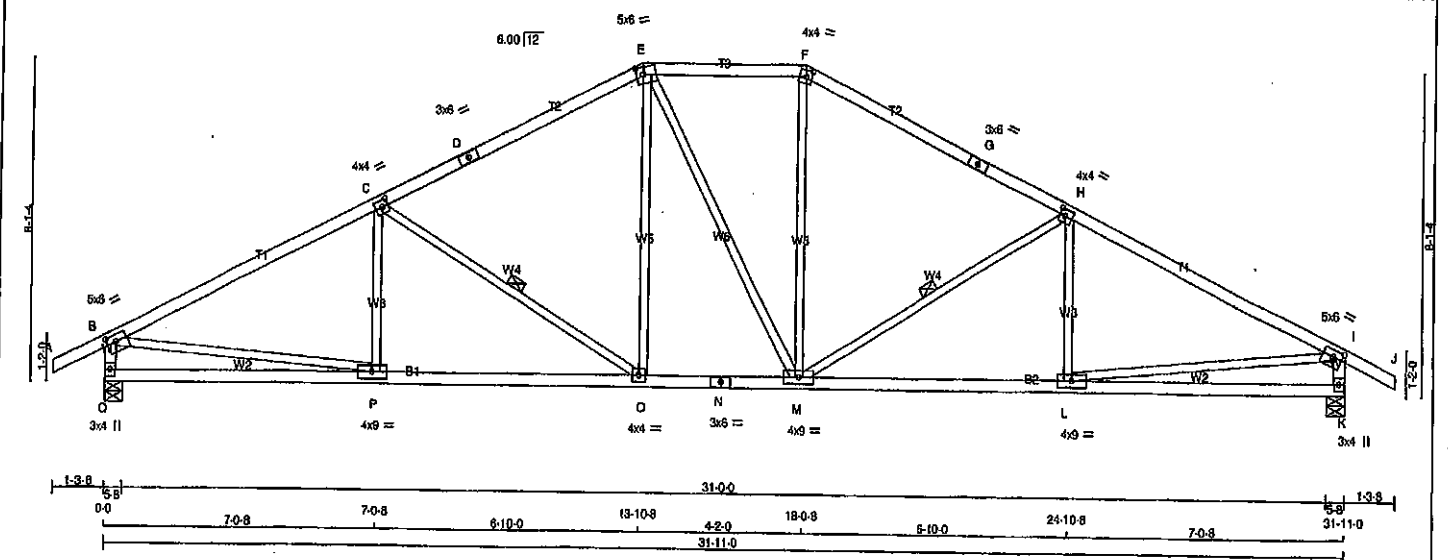



LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. A - O 2x4 DRY No.2 SPF D - E 2x4 DRY No.2 SPF E - F 2x4 DRY No.2 SPF F - G 2x4 DRY No.2 SPF G - J 2x4 DRY No.2 SPF O - B 2x4 DRY No.2 SPF K - I 2x4 DRY No.2 SPF Q - N 2x4 DRY No.2 SPF N - K 2x4 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT DRY: SEASONED LUMBER.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS <table border="1"> <tr> <th></th> <th>FACTORED GROSS REACTION</th> <th>MAXIMUM FACTORED GROSS REACTION</th> <th>INPUT 8RG</th> <th>REQD 8RG</th> </tr> <tr> <td>JT</td> <td>VERT</td> <td>HORZ</td> <td>DOWN</td> <td>HORZ</td> </tr> <tr> <td>Q</td> <td>1884</td> <td>0</td> <td>1884</td> <td>0</td> </tr> <tr> <td>K</td> <td>1884</td> <td>0</td> <td>1884</td> <td>0</td> </tr> </table> UNFACTORED REACTIONS <table border="1"> <tr> <th></th> <th>1ST LOASE</th> <th>MAX. MIN. COMPONENT REACTIONS</th> <th>PERM. LIVE</th> <th>WIND</th> <th>DEAD</th> <th>SOIL</th> </tr> <tr> <td>JT</td> <td>COMBINED</td> <td>SNOW</td> <td>LIVE</td> <td>PERM. LIVE</td> <td>WIND</td> <td>DEAD</td> </tr> <tr> <td>Q</td> <td>1330</td> <td>888 / 0</td> <td>0 / 0</td> <td>0 / 0</td> <td>0 / 0</td> <td>444 / 0</td> </tr> <tr> <td>K</td> <td>1330</td> <td>888 / 0</td> <td>0 / 0</td> <td>0 / 0</td> <td>0 / 0</td> <td>444 / 0</td> </tr> </table> BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. 1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-M. END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW LOADING TOTAL LOAD CASES: (4) <table border="1"> <tr> <th colspan="4">CHORDS</th> <th colspan="4">WEBS</th> </tr> <tr> <th>MEMB.</th> <th>MAX. FACTORED FORCE (LBS)</th> <th>FACTORED VERT. LOAD (PLF)</th> <th>MAX. CSI (LC)</th> <th>MEMB.</th> <th>MAX. FACTORED FORCE (LBS)</th> <th>MAX. CSI (LC)</th> <th></th> </tr> <tr> <td>FR-TO</td> <td></td> <td>FROM TO</td> <td></td> <td>FR-TO</td> <td></td> <td></td> <td></td> </tr> <tr> <td>A-B</td> <td>0 / 28</td> <td>-91.8 -91.8</td> <td>0.12 (1)</td> <td>10.00</td> <td>P-C</td> <td>-140 / 71</td> <td>0.05 (1)</td> </tr> <tr> <td>B-C</td> <td>-2587 / 0</td> <td>-91.8 -91.8</td> <td>0.78 (1)</td> <td>3.47</td> <td>C-O</td> <td>-681 / 0</td> <td>0.31 (1)</td> </tr> <tr> <td>C-D</td> <td>-2013 / 0</td> <td>-91.8 -91.8</td> <td>0.68 (1)</td> <td>3.97</td> <td>O-E</td> <td>0 / 458</td> <td>0.10 (1)</td> </tr> <tr> <td>D-E</td> <td>-2013 / 0</td> <td>-91.8 -91.8</td> <td>0.68 (1)</td> <td>3.97</td> <td>E-M</td> <td>0 / 2</td> <td>0.00 (1)</td> </tr> <tr> <td>E-F</td> <td>-1775 / 0</td> <td>-91.8 -91.8</td> <td>0.24 (1)</td> <td>4.79</td> <td>M-F</td> <td>0 / 460</td> <td>0.10 (1)</td> </tr> <tr> <td>F-G</td> <td>-2013 / 0</td> <td>-91.8 -91.8</td> <td>0.68 (1)</td> <td>3.97</td> <td>M-H</td> <td>-680 / 0</td> <td>0.31 (1)</td> </tr> <tr> <td>G-H</td> <td>-2013 / 0</td> <td>-91.8 -91.8</td> <td>0.68 (1)</td> <td>3.97</td> <td>H-I</td> <td>-142 / 70</td> <td>0.05 (1)</td> </tr> <tr> <td>H-I</td> <td>-2587 / 0</td> <td>-91.8 -91.8</td> <td>0.78 (1)</td> <td>3.47</td> <td>I-J</td> <td>0 / 2362</td> <td>0.53 (1)</td> </tr> <tr> <td>I-J</td> <td>0 / 28</td> <td>-91.8 -91.8</td> <td>0.12 (1)</td> <td>10.00</td> <td>J-K</td> <td>0 / 2361</td> <td>0.53 (1)</td> </tr> <tr> <td>Q-B</td> <td>-1830 / 0</td> <td>0.0 0.0</td> <td>0.18 (1)</td> <td>6.19</td> <td></td> <td></td> <td></td> </tr> <tr> <td>K-I</td> <td>-1830 / 0</td> <td>0.0 0.0</td> <td>0.18 (1)</td> <td>6.19</td> <td></td> <td></td> <td></td> </tr> <tr> <td>Q-P</td> <td>0 / 0</td> <td>-18.5 -18.5</td> <td>0.22 (4)</td> <td>10.00</td> <td></td> <td></td> <td></td> </tr> <tr> <td>P-O</td> <td>0 / 2344</td> <td>-18.5 -18.5</td> <td>0.48 (1)</td> <td>10.00</td> <td></td> <td></td> <td></td> </tr> <tr> <td>O-N</td> <td>0 / 1774</td> <td>-18.5 -18.5</td> <td>0.35 (1)</td> <td>10.00</td> <td></td> <td></td> <td></td> </tr> <tr> <td>N-M</td> <td>0 / 1774</td> <td>-18.5 -18.5</td> <td>0.35 (1)</td> <td>10.00</td> <td></td> <td></td> <td></td> </tr> <tr> <td>M-L</td> <td>0 / 2344</td> <td>-18.5 -18.5</td> <td>0.48 (1)</td> <td>10.00</td> <td></td> <td></td> <td></td> </tr> <tr> <td>L-K</td> <td>0 / 0</td> <td>-18.5 -18.5</td> <td>0.22 (4)</td> <td>10.00</td> <td></td> <td></td> <td></td> </tr> </table>					FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT 8RG	REQD 8RG	JT	VERT	HORZ	DOWN	HORZ	Q	1884	0	1884	0	K	1884	0	1884	0		1ST LOASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL	JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	Q	1330	888 / 0	0 / 0	0 / 0	0 / 0	444 / 0	K	1330	888 / 0	0 / 0	0 / 0	0 / 0	444 / 0	CHORDS				WEBS				MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)		FR-TO		FROM TO		FR-TO				A-B	0 / 28	-91.8 -91.8	0.12 (1)	10.00	P-C	-140 / 71	0.05 (1)	B-C	-2587 / 0	-91.8 -91.8	0.78 (1)	3.47	C-O	-681 / 0	0.31 (1)	C-D	-2013 / 0	-91.8 -91.8	0.68 (1)	3.97	O-E	0 / 458	0.10 (1)	D-E	-2013 / 0	-91.8 -91.8	0.68 (1)	3.97	E-M	0 / 2	0.00 (1)	E-F	-1775 / 0	-91.8 -91.8	0.24 (1)	4.79	M-F	0 / 460	0.10 (1)	F-G	-2013 / 0	-91.8 -91.8	0.68 (1)	3.97	M-H	-680 / 0	0.31 (1)	G-H	-2013 / 0	-91.8 -91.8	0.68 (1)	3.97	H-I	-142 / 70	0.05 (1)	H-I	-2587 / 0	-91.8 -91.8	0.78 (1)	3.47	I-J	0 / 2362	0.53 (1)	I-J	0 / 28	-91.8 -91.8	0.12 (1)	10.00	J-K	0 / 2361	0.53 (1)	Q-B	-1830 / 0	0.0 0.0	0.18 (1)	6.19				K-I	-1830 / 0	0.0 0.0	0.18 (1)	6.19				Q-P	0 / 0	-18.5 -18.5	0.22 (4)	10.00				P-O	0 / 2344	-18.5 -18.5	0.48 (1)	10.00				O-N	0 / 1774	-18.5 -18.5	0.35 (1)	10.00				N-M	0 / 1774	-18.5 -18.5	0.35 (1)	10.00				M-L	0 / 2344	-18.5 -18.5	0.48 (1)	10.00				L-K	0 / 0	-18.5 -18.5	0.22 (4)	10.00				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.6 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. G/G LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF BCBC 2018, CBC 2012, ABC 2019 - PART 9 OF CBC 2012 (2019 AMENDMENT) - CSA 088-09, CSA 088-14 - TPIC 2011, TPIC 2014 (55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL. (LL) = L/360 (1.06") CALCULATED VERT. DEFL. (LL) = L/999 (0.12") ALLOWABLE DEFL. (TL) = L/360 (1.06") CALCULATED VERT. DEFL. (TL) = L/999 (0.24") CSI: TC=0.78/1.00 (B-C:1), BC=0.48/1.00 (O-P:1), WB=0.52/1.00 (B-P:1), SS=0.28/1.00 (H-I:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 1.00 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP (DRY) SHEAR SECTION (PSY) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1887 788 1987 1658 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP = 0.89 (B) (INPUT = 0.90) JSI METAL = 0.70 (B) (INPUT = 1.00)			
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT 8RG	REQD 8RG																																																																																																																																																																																																																							
JT	VERT	HORZ	DOWN	HORZ																																																																																																																																																																																																																							
Q	1884	0	1884	0																																																																																																																																																																																																																							
K	1884	0	1884	0																																																																																																																																																																																																																							
	1ST LOASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL																																																																																																																																																																																																																					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD																																																																																																																																																																																																																					
Q	1330	888 / 0	0 / 0	0 / 0	0 / 0	444 / 0																																																																																																																																																																																																																					
K	1330	888 / 0	0 / 0	0 / 0	0 / 0	444 / 0																																																																																																																																																																																																																					
CHORDS				WEBS																																																																																																																																																																																																																							
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)																																																																																																																																																																																																																					
FR-TO		FROM TO		FR-TO																																																																																																																																																																																																																							
A-B	0 / 28	-91.8 -91.8	0.12 (1)	10.00	P-C	-140 / 71	0.05 (1)																																																																																																																																																																																																																				
B-C	-2587 / 0	-91.8 -91.8	0.78 (1)	3.47	C-O	-681 / 0	0.31 (1)																																																																																																																																																																																																																				
C-D	-2013 / 0	-91.8 -91.8	0.68 (1)	3.97	O-E	0 / 458	0.10 (1)																																																																																																																																																																																																																				
D-E	-2013 / 0	-91.8 -91.8	0.68 (1)	3.97	E-M	0 / 2	0.00 (1)																																																																																																																																																																																																																				
E-F	-1775 / 0	-91.8 -91.8	0.24 (1)	4.79	M-F	0 / 460	0.10 (1)																																																																																																																																																																																																																				
F-G	-2013 / 0	-91.8 -91.8	0.68 (1)	3.97	M-H	-680 / 0	0.31 (1)																																																																																																																																																																																																																				
G-H	-2013 / 0	-91.8 -91.8	0.68 (1)	3.97	H-I	-142 / 70	0.05 (1)																																																																																																																																																																																																																				
H-I	-2587 / 0	-91.8 -91.8	0.78 (1)	3.47	I-J	0 / 2362	0.53 (1)																																																																																																																																																																																																																				
I-J	0 / 28	-91.8 -91.8	0.12 (1)	10.00	J-K	0 / 2361	0.53 (1)																																																																																																																																																																																																																				
Q-B	-1830 / 0	0.0 0.0	0.18 (1)	6.19																																																																																																																																																																																																																							
K-I	-1830 / 0	0.0 0.0	0.18 (1)	6.19																																																																																																																																																																																																																							
Q-P	0 / 0	-18.5 -18.5	0.22 (4)	10.00																																																																																																																																																																																																																							
P-O	0 / 2344	-18.5 -18.5	0.48 (1)	10.00																																																																																																																																																																																																																							
O-N	0 / 1774	-18.5 -18.5	0.35 (1)	10.00																																																																																																																																																																																																																							
N-M	0 / 1774	-18.5 -18.5	0.35 (1)	10.00																																																																																																																																																																																																																							
M-L	0 / 2344	-18.5 -18.5	0.48 (1)	10.00																																																																																																																																																																																																																							
L-K	0 / 0	-18.5 -18.5	0.22 (4)	10.00																																																																																																																																																																																																																							

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMWW-t	MT20	5.0	6.0	2.00 2.75
C	TMWW-t	MT20	4.0	4.0	2.00 1.75
D	TS-t	MT20	3.0	6.0	
E	TTWW-m	MT20	5.0	8.0	2.25 2.00
F	TTW-m	MT20	4.0	4.0	2.00 1.75
G	TS-t	MT20	3.0	6.0	
H	TMWW-t	MT20	4.0	4.0	2.00 1.75
I	TMWW-t	MT20	5.0	6.0	2.00 2.75
K	BMV1+p	MT20	3.0	4.0	
L	BMWW-t	MT20	4.0	9.0	
M	BMWW-t	MT20	4.0	8.0	
N	BS-t	MT20	3.0	6.0	
O	BMWW-t	MT20	4.0	4.0	
P	BMWW-t	MT20	4.0	9.0	
Q	BMV1+p	MT20	3.0	4.0	

Structural component only
 DWG# T-2006217

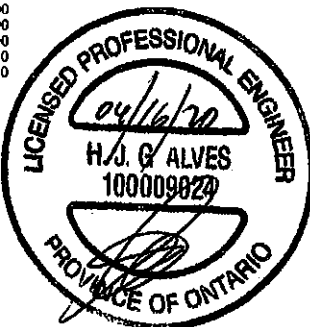

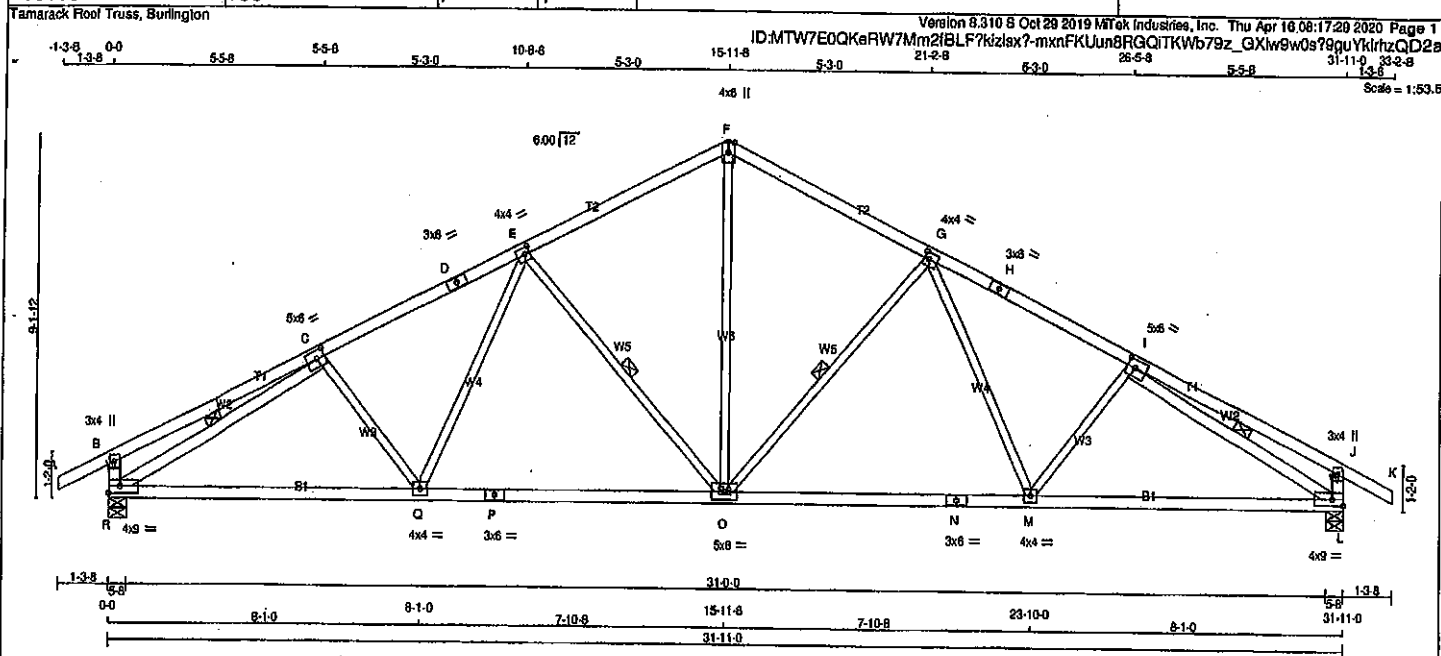

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES				
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - K	2x4	DRY	No.2	SPF
R - B	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
R - P	2x4	DRY	No.2	SPF
P - N	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
R - C	2x4	DRY	No.2	SPF
I - L	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE				
B TMV+p	MT20	3.0	4.0	
C TMWW-i	MT20	5.0	6.0	2.50
D TS-i	MT20	3.0	6.0	
E TMWW-i	MT20	4.0	4.0	2.00
F TTW+p	MT20	4.0	6.0	Edge
G TMWW-i	MT20	4.0	4.0	2.00
H TS-i	MT20	3.0	6.0	
I TMWW-i	MT20	5.0	6.0	2.50
J TMV+p	MT20	3.0	4.0	
L BMVW-i	MT20	4.0	9.0	Edge
M BMWW-i	MT20	4.0	4.0	
N BS-i	MT20	3.0	6.0	
O BMWW-i	MT20	5.0	6.0	
P BS-i	MT20	3.0	6.0	
Q BMWW-i	MT20	4.0	4.0	
R BMVW-i	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	IN-SX	IN-SX
R	1884	0	5-8	5-8
L	1884	0	5-8	5-8

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
R	1330	886 / 0 0 / 0 0 / 0 444 / 0 0 / 0
L	1330	886 / 0 0 / 0 0 / 0 444 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.11 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-O, E-O, C-R, I-L.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORZ. LOAD (LC)	MAX. FACTORED LENGTH (FR-TO)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORZ. LOAD (LC)
FR-TO					FR-TO		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	0-1	0 / 1211	0.27 (1)
B-C	0 / 20	-91.8	-91.8	0.33 (1)	0-2	-701 / 0	0.32 (1)
C-D	-2428 / 0	-91.8	-91.8	0.37 (1)	0-3	0 / 312	0.07 (1)
D-E	-2428 / 0	-91.8	-91.8	0.37 (1)	0-4	-156 / 21	0.05 (1)
E-F	-1808 / 0	-91.8	-91.8	0.34 (1)	0-5	-701 / 0	0.32 (1)
F-G	-1808 / 0	-91.8	-91.8	0.34 (1)	0-6	0 / 312	0.07 (1)
G-H	-2428 / 0	-91.8	-91.8	0.37 (1)	0-7	-156 / 21	0.08 (1)
H-I	-2428 / 0	-91.8	-91.8	0.37 (1)	0-8	-2717 / 0	0.55 (1)
I-J	0 / 20	-91.8	-91.8	0.33 (1)	0-9		0.55 (1)
J-K	0 / 28	-91.8	-91.8	0.12 (1)			
K-L	-325 / 0	0.0	0.0	0.03 (1)			
L-M	-325 / 0	0.0	0.0	0.03 (1)			
R-Q	0 / 2268	-18.5	-18.5	0.51 (1)			
Q-P	0 / 2051	-18.5	-18.5	0.48 (1)			
P-O	0 / 2051	-18.5	-18.5	0.48 (1)			
O-N	0 / 2051	-18.5	-18.5	0.48 (1)			
N-M	0 / 2051	-18.5	-18.5	0.48 (1)			
M-L	0 / 2268	-18.5	-18.5	0.51 (1)			

TOTAL WEIGHT = 7 X 133 = 932 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.5 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, CBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPC 2011, TPC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.05")
CALCULATED VERT. DEFL. (LL) = L/999 (0.11")
ALLOWABLE DEFL. (TL) = L/360 (1.08")
CALCULATED VERT. DEFL. (TL) = L/999 (0.24")

CSI: TC=0.37/1.00 (G-I:1), BC=0.51/1.00 (L-M:1), WB=0.55/1.00 (I-L:1), SS=0.20/1.00 (J-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 768 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

SI GRIP = 0.85 (I) (INPUT = 0.80)
SI METAL = 0.87 (I) (INPUT = 1.00)

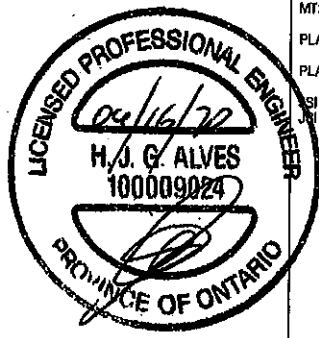

Structural component only
DWG# T-2006218

Version 8.310 S Oct 29 2019 Mirek Industries, Inc. Wed Apr 16 12:51:51 2020 Page 1
ID:MTW7E0QKeRW7Mm2fBLF7Kizlsx7-W7roIGVd7_poAUJ_YvQFRmv0jDhGQOPGa6U9PZQU7M

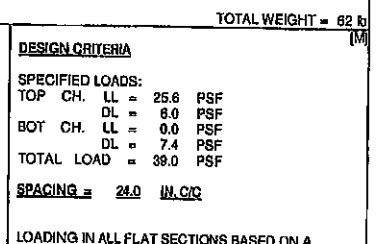

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBCO 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 088-03, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 3.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEF. (1/16" - 1/32" - 1/16")

CALCULATED VERT. DEF. (LL) = $U/989$ (0.04")
 ALLOWABLE DEF. (TL) = $L/360$ (0.43")
 CALCULATED VERT. DEF. (TL) = $U/989$ (0.07")
 CSI: $TC=0.52/1.00$ (B-C), $BC=0.33/1.00$ (I-J-I),
 $WB=0.41/1.00$ (F-I), $SS=0.31/1.00$ (H-I)
 DOL LUMBER=1.00 NAIL=1.00 LS LEAD=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00
 COMPANION LIVE LOAD FACTOR = 1.00
 TRUSS PLATE MANUFACTURER IS NOT
 RESPONSIBLE FOR QUALITY CONTROL IN THE
 TRUSS MANUFACTURING PLANT .
 NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PS) (PL) (PI)

MT20 MAX MIN MAX MIN MAX MIN
 818 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (F) (INPUT = 0.80)
JSI METAL = 0.49 (F) (INPUT = 1.00)

[illegible]

Structural component only
DWG# T-2006219

JOB NAME 408159	TRUSS NAME T38	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Wed Apr 15 12:51:52 2020 Page 1	

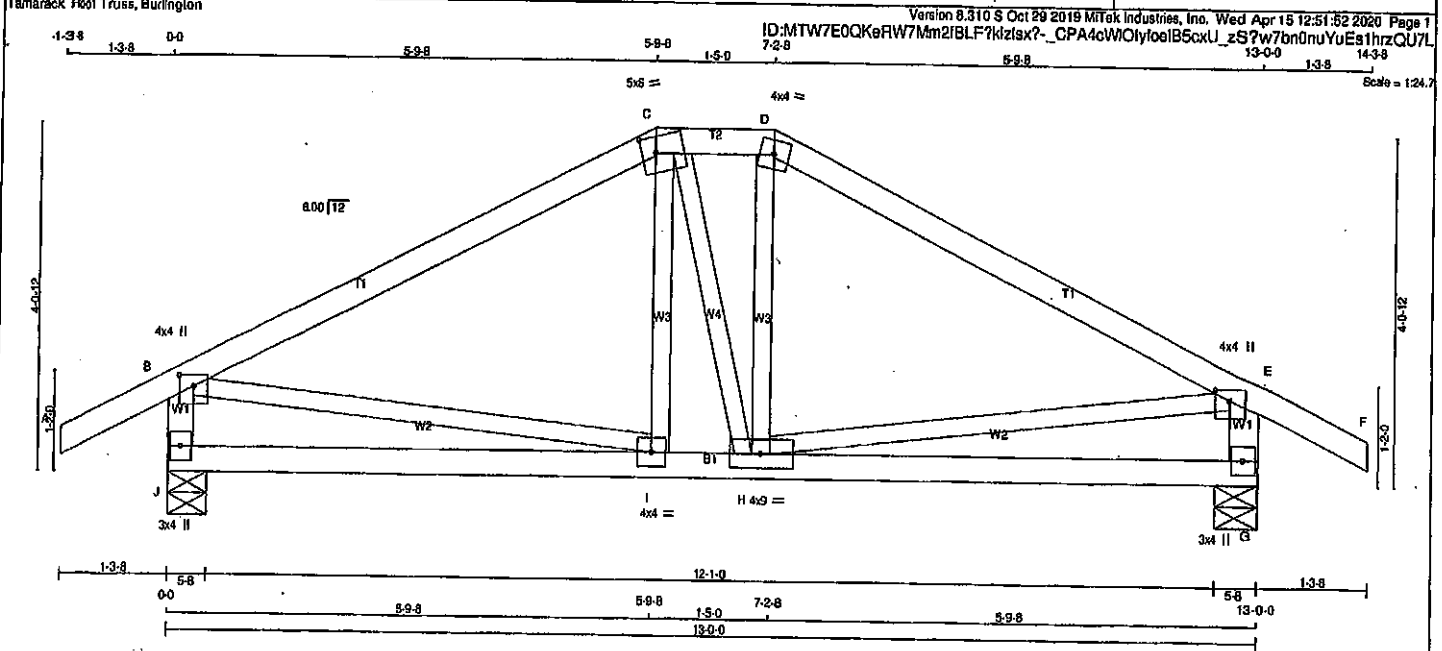

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
J - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
J - G	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW+p	MT20	4.0	4.0 1.50 2.00
C	TTW-m	MT20	5.0	6.0 2.25 2.00
D	TTW-m	MT20	4.0	4.0
E	TMVW+p	MT20	4.0	4.0 1.50 2.00
G	BMV1+p	MT20	3.0	4.0
H	BMVWW-t	MT20	4.0	9.0
I	BMVW-1	MT20	4.0	4.0
J	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX		REQD BRG IN-SX	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	5-8	5-8	5-8	5-8
J	841	0	841	0	0	5-8	5-8	5-8	5-8
G	841	0	841	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST LOOSE		MAX/MIN COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	DEAD	SOIL	DEAD	SOIL
J	593	402/0	0/0	0/0	0/0	190/0	0/0	190/0	0/0	190/0	0/0
G	593	402/0	0/0	0/0	0/0	190/0	0/0	190/0	0/0	190/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLINE SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)	
CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0/28	A-B	-19/47
B-C	-702/0	C-H	0/6
C-D	-628/0	H-D	-16/52
D-E	-703/0	B-I	0/834
E-F	0/28	H-E	0/635
J-B	-796/0		
G-E	-795/0		
J-I	0/0		
I-H	0/627		
H-G	0/0		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.43")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.43")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.40/1.00 (D-E:1), BC=0.21/1.00 (H-I:4), WB=0.14/1.00 (E-H:1), SS=0.19/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.81 (E) (INPUT = 0.90)
JSI METAL= 0.23 (I) (INPUT = 1.00)

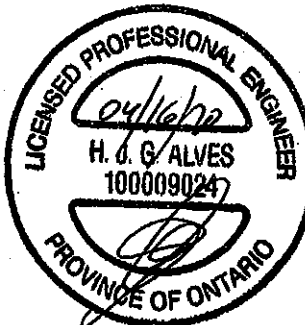


Structural component only
DWG# T-2006220

JOB NAME 408159	TRUSS NAME T39	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 16 08:17:12 2020 Page 1
ID:MTW7E0QKRW7Mm2BLF7klzlsx7-IFpigh68D7qArXF53L_ghKuilAg00aA_P7u1BzQD2

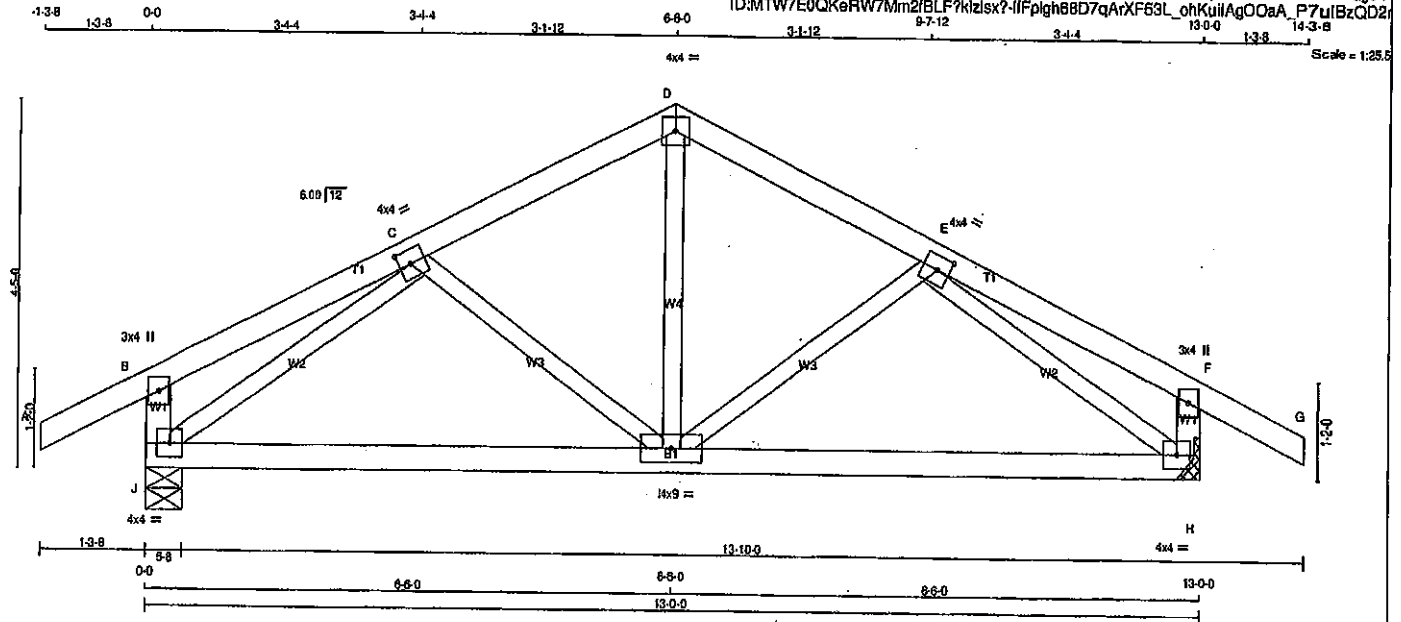

TOTAL WEIGHT = 3 X 52 = 156 lb (MIF)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
J - B	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0			
C	TMVW-1	MT20	4.0	4.0	2.00	1.75	
D	TMV-p	MT20	4.0	4.0			
E	TMVW-1	MT20	4.0	4.0	2.00	1.75	
F	TMV-p	MT20	3.0	4.0			
H	BMVW-1	MT20	4.0	4.0			
I	BMVW-1	MT20	4.0	4.0			
J	BMVW-1	MT20	4.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
J	841	0	841	0
H	841	0	841	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3'-8".

UNFACTORED REACTIONS

JT	1ST CASE	MAX MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	593	402 / 0	0 / 0	0 / 0	0 / 0	0 / 0	190 / 0	0 / 0
H	593	402 / 0	0 / 0	0 / 0	0 / 0	0 / 0	190 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	WEBS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.
		(LBS)	(PLF)							(LBS)	(PLF)				
FR-TO			FROM	TO				FR-TO			FROM	TO			
A-B	0 / 28		-91.8	-91.8	0.12 (1)	10.00	10.00	I-D	0 / 355		0.08 (1)				
B-C	0 / 14		-91.8	-91.8	0.14 (1)	10.00	10.00	I-E	-171 / 0		0.05 (1)				
C-D	-672 / 0		-91.8	-91.8	0.11 (1)	8.25	8.25	C-I	-171 / 0		0.05 (1)				
D-E	-672 / 0		-91.8	-91.8	0.11 (1)	8.25	8.25	J-C	-910 / 0		0.25 (1)				
E-F	0 / 14		-91.8	-91.8	0.14 (1)	10.00	10.00	E-H	-910 / 0		0.25 (1)				
F-G	0 / 28		-91.8	-91.8	0.12 (1)	10.00	10.00								
J-B	-242 / 0		0.0	0.0	0.02 (1)	7.81	7.81								
H-F	-242 / 0		0.0	0.0	0.02 (1)	7.81	7.81								
J-I	0 / 724		-18.5	-18.5	0.28 (4)	10.00	10.00								
I-H	0 / 724		-18.5	-18.5	0.28 (4)	10.00	10.00								

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
DL	=	6.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.43")
CALCULATED VERT. DEFL. (LL) = $L/899$ (0.02")
ALLOWABLE DEFL. (TL) = $L/360$ (0.43")
CALCULATED VERT. DEFL. (TL) = $L/899$ (0.05")

CSI: TC=0.14/1.00 (E-F:1), BC=0.28/1.00 (I-J:4), WB=0.25/1.00 (C-J:1), SSI=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1687
		768	1897

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.81 (H) (INPUT = 0.90)
JSI METAL = 0.31 (C) (INPUT = 1.00)

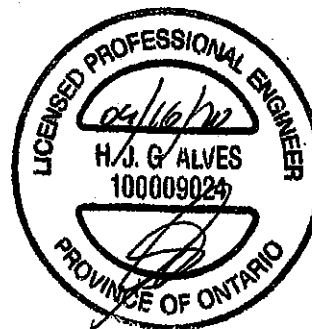

Structural component only
DWG# T-2006221

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408159	T41	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 MITek Industries, Inc. Wed Apr 16 12:51:54 2020 Page 1					
ID:MTW7E0QKerW7Mm2iBLF7Kizsx7-xaXwVHX7wvCN1ySZD1zy3OXKnnCsUjcrMYL8HzQU7J					
14-0-0					
Scale = 1/2"=1'					

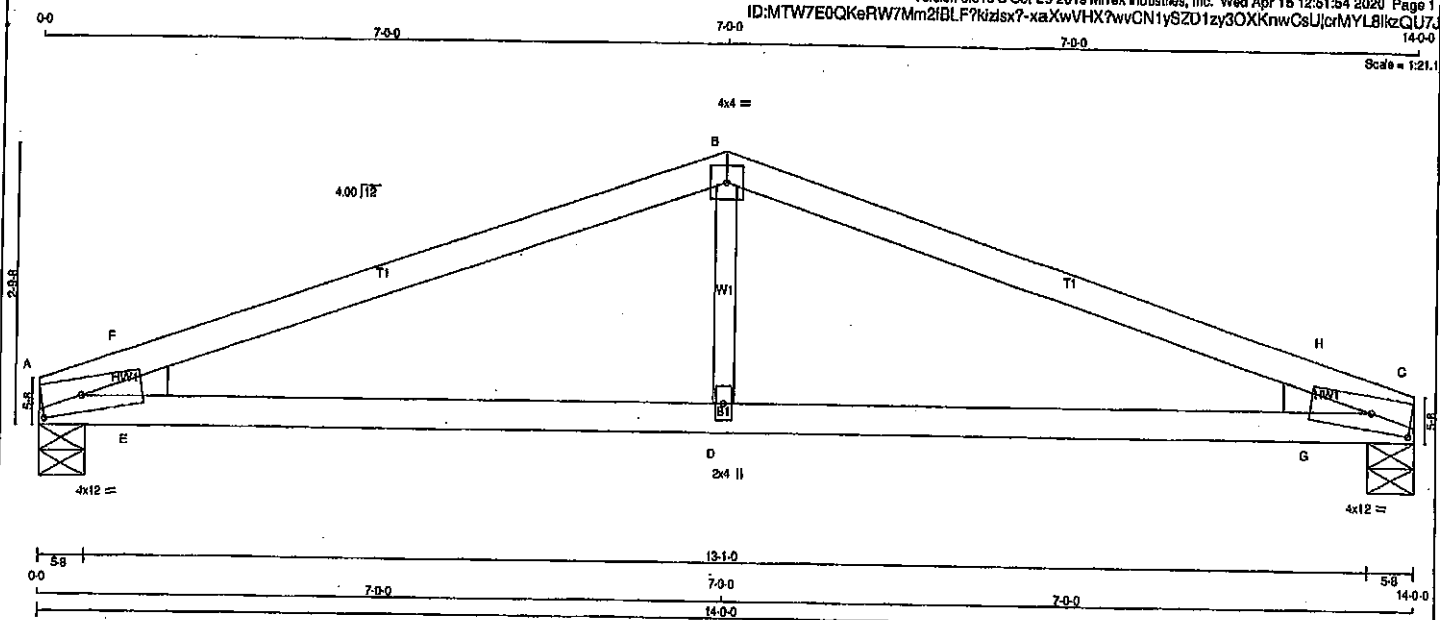

LUMBER	DESCR.
N.L.G.A. RULES	
CHORDS SIZE	
A - B 2x4 DRY	No.2
B - C 2x4 DRY	No.2
A - C 2x4 DRY	No.2
ALL WEBS 2x3 DRY	No.2
DRY: SEASONED LUMBER.	

PLATES (tablets in inches)	W	LEN	Y	X
JT TYPE PLATES				
A TMBH1-m MT20	4.0	12.0	2.00	4.75
B TTW-p MT20	4.0	4.0		
C TMBH1-m MT20	4.0	12.0	2.00	4.75
D BMW-w MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG	HEEL WEDGE
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
A	772	0	772	0	0
C	772	0	772	0	0

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
A	548	358 / 0 0 / 0 0 / 0 0 / 0 188 / 0 0 / 0
C	548	358 / 0 0 / 0 0 / 0 0 / 0 188 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.07 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)
FR-TO						FR-TO				
A-F	-1256 / 0	-91.8	-91.8	0.16 (1)	5.57	D-B	0 / 280	0.06 (1)		
F-B	-1256 / 0	-91.8	-91.8	0.51 (1)	5.07	E-F	-292 / 8	0.00 (1)		
B-H	-1256 / 0	-91.8	-91.8	0.51 (1)	5.07	G-H	-292 / 8	0.00 (1)		
H-C	-1256 / 0	-91.8	-91.8	0.16 (1)	5.57					
A-E	0 / 1181	-18.5	-18.5	0.55 (1)	10.00					
E-D	0 / 1181	-18.5	-18.5	0.55 (1)	10.00					
D-G	0 / 1181	-18.5	-18.5	0.55 (1)	10.00					
G-C	0 / 1181	-18.5	-18.5	0.55 (1)	10.00					

TOTAL WEIGHT = 3 X 37 = 110 lb

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.47")
CALCULATED VERT. DEFL. (LL) = L/999 (0.09")
ALLOWABLE DEFL. (TL) = L/360 (0.47")
CALCULATED VERT. DEFL. (TL) = L/999 (0.16")

CSI: TC=0.51/1.00 (B-F:1), BC=0.55/1.00 (A-E:1), WB=0.08/1.00 (B-D:1), SS=0.22/1.00 (B-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.48 (B) (INPUT = 0.90)
JSI METAL= 0.17 (B) (INPUT = 1.00)

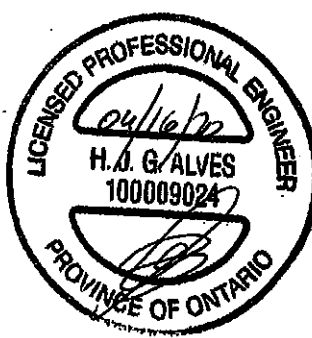

Structural component only
DWG# T-2006222

JOB NAME 408157	TRUSS NAME PB1	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC. Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Wed Apr 15 12:13:21 2020 Page 1
 ID:7R4Dg_C9IAuONuKplv7nzzwQ4-8bGW2OY8sEnZ2V71DmzYpdE5Uy41cqOUBYE4IzQUhS

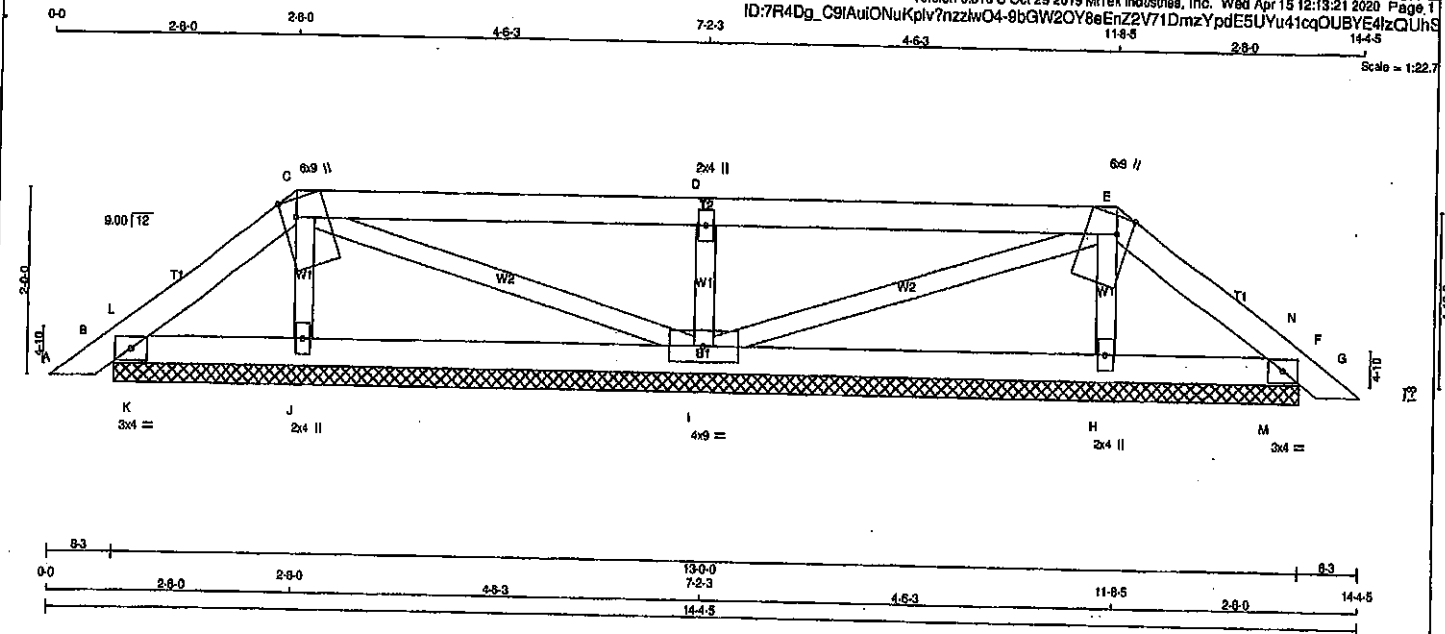

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - N	2x4	DRY	No.2
N - O	2x4	DRY	No.2
O - P	2x4	DRY	No.2
P - Q	2x4	DRY	No.2
Q - R	2x4	DRY	No.2
R - S	2x4	DRY	No.2
S - T	2x4	DRY	No.2
T - U	2x4	DRY	No.2
U - V	2x4	DRY	No.2
V - W	2x4	DRY	No.2
W - X	2x4	DRY	No.2
X - Y	2x4	DRY	No.2
Y - Z	2x4	DRY	No.2

ALL WEBS 2x3 DRY
 DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
B	186	0	186	0	13-0-0	13-0-0
F	186	0	186	0	13-0-0	13-0-0
J	278	0	278	0	13-0-0	13-0-0
I	816	0	816	0	13-0-0	13-0-0
H	278	0	278	0	13-0-0	13-0-0

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
 DL = 8.0 PSF

BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0		
C	TTWW+m	MT20	6.0	9.0	Edge	2.00
D	TTWW+w	MT20	2.0	4.0		
E	TTWW+m	MT20	6.0	9.0	Edge	2.00
F	TMB1-I	MT20	3.0	4.0		
H	BMW1+w	MT20	2.0	4.0		
I	BMW1+w	MT20	4.0	9.0		
J	BMW1+w	MT20	2.0	4.0		

UNFACTORED REACTIONS

JT	1ST LOASE COMBINED	MAX/MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
B	129	99 / 0	0 / 0	0 / 0	0 / 0	30 / 0	0 / 0
F	129	99 / 0	0 / 0	0 / 0	0 / 0	30 / 0	0 / 0
J	198	117 / 0	0 / 0	0 / 0	0 / 0	82 / 0	0 / 0
I	433	295 / 0	0 / 0	0 / 0	0 / 0	138 / 0	0 / 0
H	199	117 / 0	0 / 0	0 / 0	0 / 0	82 / 0	0 / 0

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F, J, I, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		MAX. FACTORED	WEBS	FACTORED	
	MAX. FORCE (LBS)	VERT. LOAD (PLF)	VERT. LOAD (PLF)	MAX. (LBS)			MAX. FORCE (LBS)	MAX. (LBS)
FR-TO								
A-B	0 / 15	-91.8	-91.8	0.02 (1)	10.00	J-C	-189 / 0	0.03 (1)
B-L	-35 / 0	-91.8	-91.8	0.01 (1)	6.25	C-I	-24 / 0	0.01 (1)
L-C	-57 / 0	-91.8	-91.8	0.04 (1)	6.25	I-D	-517 / 0	0.08 (1)
C-D	-7 / 0	-91.8	-91.8	0.32 (1)	10.00	D-E	-24 / 0	0.01 (1)
D-E	-7 / 0	-91.8	-91.8	0.32 (1)	10.00	E-H	-189 / 0	0.03 (1)
E-N	-57 / 0	-91.8	-91.8	0.04 (1)	6.25	K-L	-123 / 0	0.00 (1)
N-F	-35 / 0	-91.8	-91.8	0.01 (1)	6.25	M-N	-123 / 0	0.00 (1)
F-G	0 / 15	-91.8	-91.8	0.02 (1)	10.00			
B-K	0 / 43	-18.5	-18.5	0.05 (1)	10.00			
K-J	0 / 43	-18.5	-18.5	0.05 (4)	10.00			
J-I	0 / 30	-18.5	-18.5	0.08 (4)	10.00			
I-H	0 / 30	-18.5	-18.5	0.08 (4)	10.00			
H-M	0 / 43	-18.5	-18.5	0.06 (4)	10.00			
M-F	0 / 43	-18.5	-18.5	0.05 (1)	10.00			

CSI: TC=0.32/1.00 (C-D:1), BC=0.08/1.00 (H-I:4), WB=0.08/1.00 (D-I:1), SS=0.20/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	618	354	1887 788 1887 1856


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.27 (D) (INPUT = 0.90)
 JSI METAL=0.11 (D) (INPUT = 1.00)

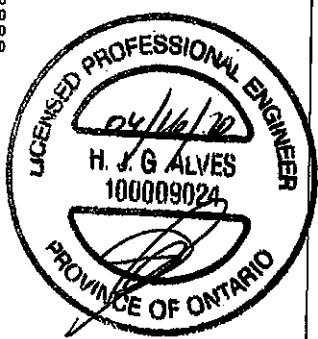

Structural component only
 DWG# T-2006179

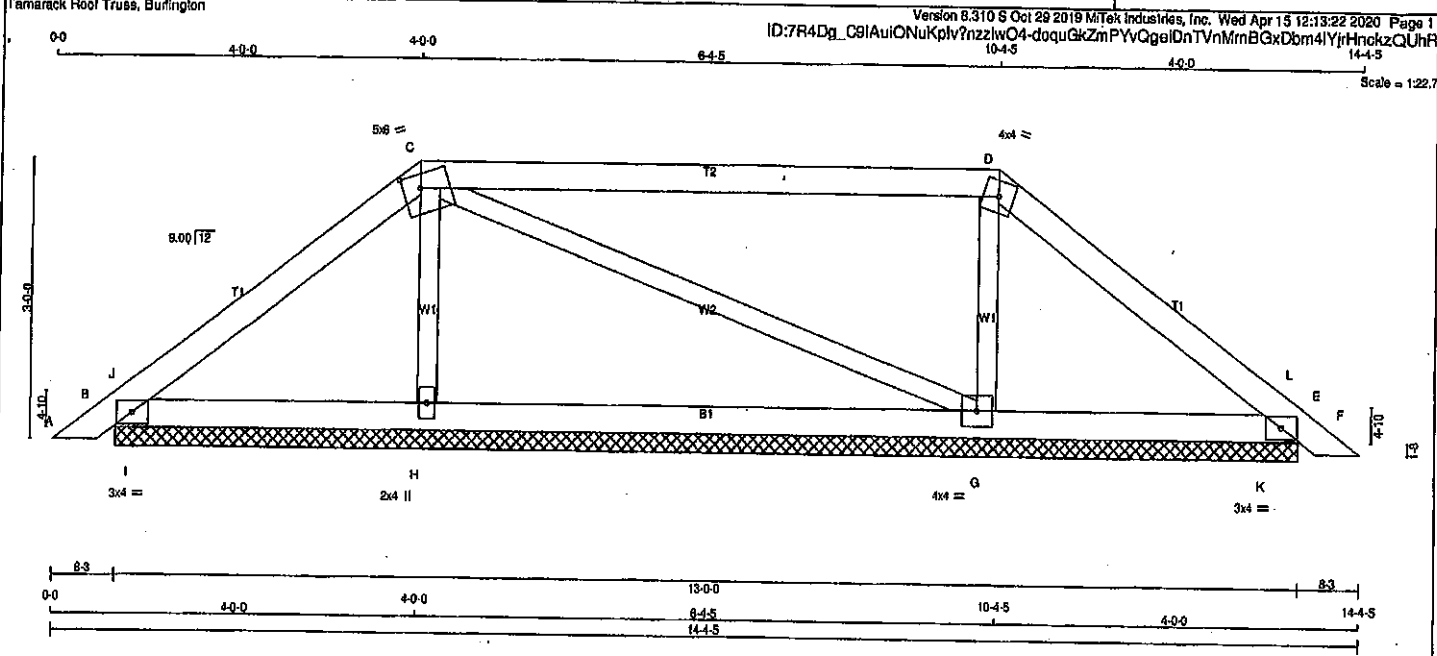

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY
DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0		
C	TTW-m	MT20	5.0	6.0	1.75	2.25
D	TTW-m	MT20	4.0	4.0		
E	TMB1-I	MT20	3.0	4.0		
G	BMW1-I	MT20	4.0	4.0		
H	BMW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECORD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
B	306	0	306	0	13'-0"	13'-0"
E	288	0	288	0	13'-0"	13'-0"
H	458	0	458	0	13'-0"	13'-0"
G	493	0	493	0	13'-0"	13'-0"

UNFACTORED REACTIONS

JT	COMBINED	MAX/MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERMLIVE	WIND	DEAD	SOIL
B	212	181/0	0/0	0/0	0/0	52/0	0/0
E	200	181/0	0/0	0/0	0/0	49/0	0/0
H	325	197/0	0/0	0/0	0/0	128/0	0/0
G	351	217/0	0/0	0/0	0/0	133/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/15	-91.8	-91.8 0.02 (1)	10.00	H-C	-327/0	0.08 (1)
B-J	-48/0	-91.8	-91.8 0.03 (1)	8.25	C-G	-28/0	0.02 (1)
J-C	-145/0	-91.8	-91.8 0.12 (1)	8.25	G-D	-354/0	0.06 (1)
C-D	-72/0	-91.8	-91.8 0.63 (1)	8.25	I-J	-282/0	0.00 (1)
D-L	-116/0	-91.8	-91.8 0.12 (1)	8.25	K-L	-295/0	0.00 (1)
L-E	-17/0	-91.8	-91.8 0.05 (1)	8.25			
E-F	0/15	-91.8	-91.8 0.02 (1)	10.00			
B-I	0/109	-18.5	-18.5 0.12 (1)	10.00			
I-H	0/109	-18.5	-18.5 0.13 (4)	10.00			
H-G	0/96	-18.5	-18.5 0.13 (4)	10.00			
G-K	0/88	-18.5	-18.5 0.12 (4)	10.00			
K-E	0/86	-18.5	-18.5 0.12 (1)	10.00			

TOTAL WEIGHT = 3 X 42 = 127 lb

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.09/12 MINIMUM
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.63/1.00 (C-D:1), BC=0.13/1.00 (H-I:4), WB=0.08/1.00 (D-G:1), SS=0.23/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1668

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.28 (B) (INPUT = 0.90)
JSI METAL = 0.07 (H) (INPUT = 1.00)

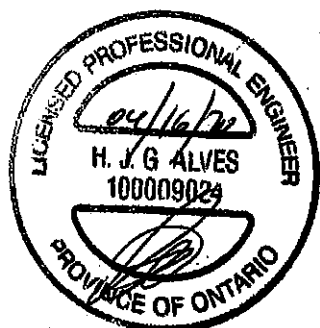

JOB NAME 408159	TRUSS NAME J1	QUANTITY 18	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	------------------	----------------	----------	-------------------------------	-------------	----------

Tanarack Pool Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 12:51:33 2020 Page 1
ID:MTW7E0QKRW7Mm2IBLF7Kzlsx7-2Ym_58HqtSYM0LXU751zAjaS7V3DPmXnXWSzQU7e

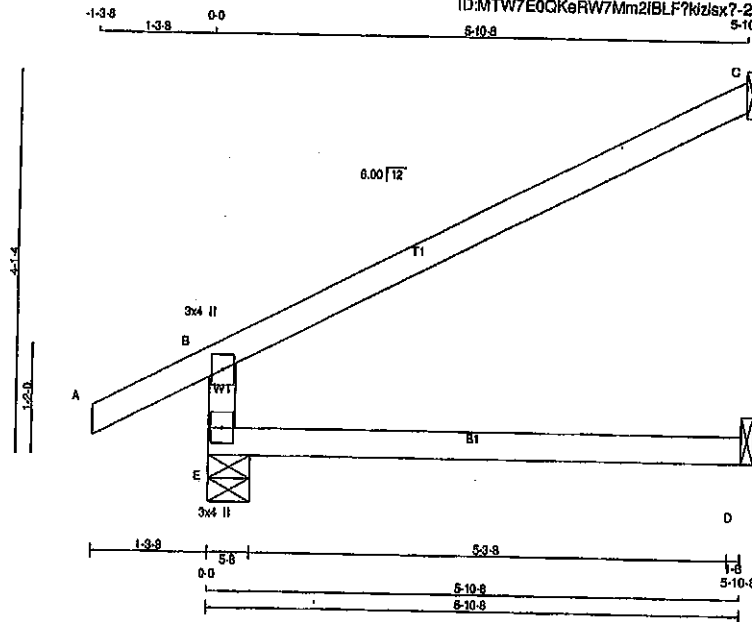

Scale = 1/2" = 1'-0"

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES	E - B	2x4	DRY	No.2	SPF
	A - C	2x4	DRY	No.2	SPF
	E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)	W	LEN	Y	X
JT TYPE	PLATES			
B TMV+p	MT20	3.0	4.0	
E BMV+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT REQD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
E	525	0	525	0	0	5-8
C	202	0	202	0	0	1-8
D	45	0	50	0	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE		MAX/MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	369	257/0	0/0	0/0	0/0	111/0	0/0
C	139	113/0	0/0	0/0	0/0	28/0	0/0
D	36	0/0	0/0	0/0	0/0	38/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

FR-TO	CHORDS		FACTORED		WEBS	
	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
E-B	-461/0	0.0	0.0	0.13 (4)	7.81	
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00	
B-C	-30/0	-91.8	-91.8	0.54 (1)	6.25	
E-D	0/0	-18.5	-18.5	0.13 (4)	10.00	

TOTAL WEIGHT = 18 X 17 = 302 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPO 2011, TPO 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (A-B:0), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(ORY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.19 (E) (INPUT = 0.90)
JSI METAL= 0.13 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006203

JOB NAME 408157	TRUSS NAME J1	QUANTITY 25	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	-------------------------	-----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 12:13:15 2020 Page 1
ID:7R4Dg_C9IAuIONuKplv7nzzhwO4-KSvFoLTN2O1QKagtIVi8aM_?W7pduWW6F5wsezQUhY

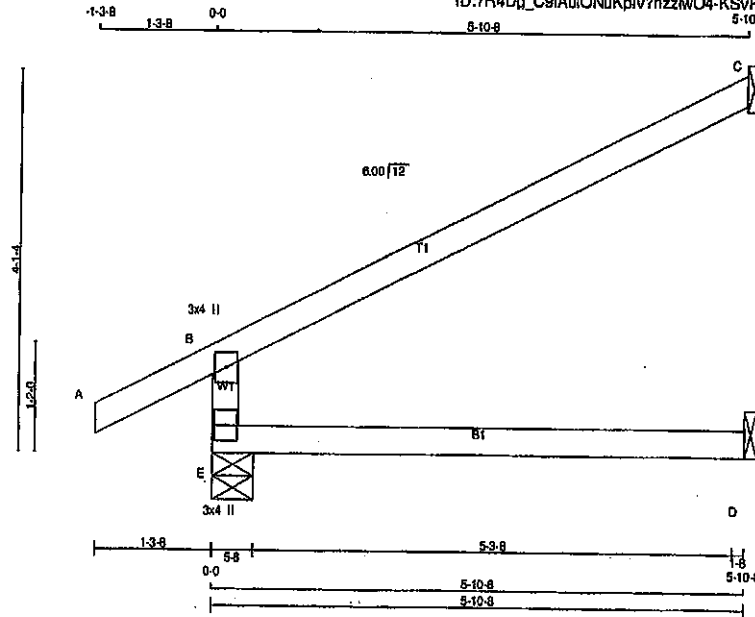

TOTAL WEIGHT = 25 X 17 = 420 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	2x4	DRY	No.2
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMV+p	MT20	3.0	4.0	
E BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	525	0	525	0	5-8	5-8
C	202	0	202	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	369	257 / 0	0 / 0	0 / 0	0 / 0	0 / 0	111 / 0	0 / 0
C	139	113 / 0	0 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0
D	38	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	38 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WESS		FACTORED	
	MAX. FORCE (LBS)	VERT. LOAD (LBS)	LC1 (PLF)	MAX. (LC)	MEMB. FORCE (LBS)	MAX. (LC)	MAX. FORCE (LBS)	MAX. (LC)
FR-TO			FROM	TO				
E-B	-481 / 0	0.0	0.0	0.13 (4)	7.81			
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00			
B-C	-30 / 0	-91.8	-91.8	0.54 (1)	6.25			
E-D	0 / 0	-18.5	-18.5	0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PS)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.19 (E) (INPUT = 0.90)
JSI METAL= 0.13 (B) (INPUT = 1.00)

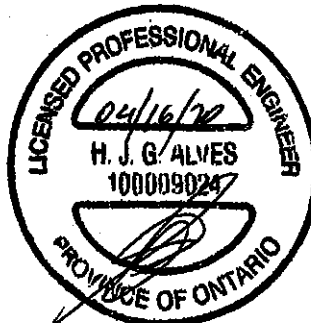


Structural component only
DWG# T-2006173

JOB NAME 408157	TRUSS NAME J2	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	-------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Wed Apr 15 12:13:16 2020 Page 1
ID:7R4Dg_C9IAuONuKpiv?nzzW04-oeTd?hU?pi9HxjF3QDON8aXGXXAPMMIKVqT05zQUhX

Scale = 1:18.6

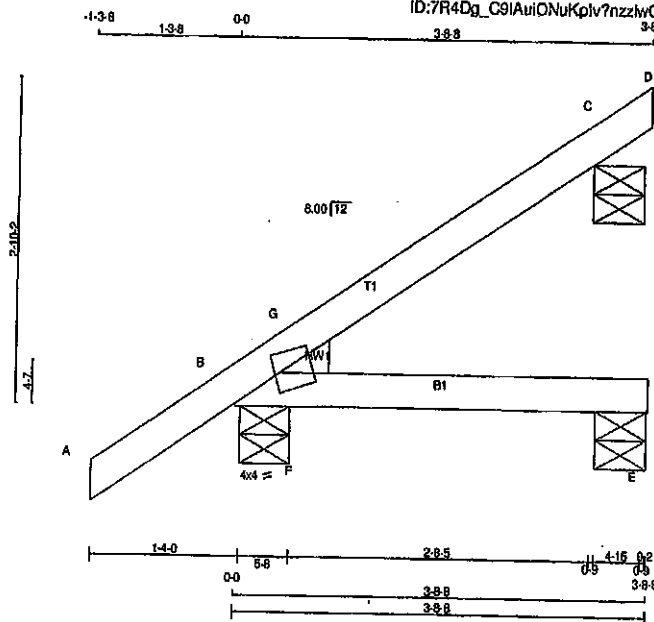

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	2x4	DRY	No.2
A - D	2x4	DRY	No.2
B - E	2x4	DRY	No.2

DRY; SEASONED LUMBER.

PLATES (tablets in inches)			
JT TYPE	PLATES	W	LEN Y X
B TM8H1-m	MT20	4.0	4.0 2.00 0.50

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		RECORD BRG		HEEL WEDGE
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	
JT									
B	319	0	319	0	0	5-8	5-8	5-8	2x4 L
E	55	0	55	0	0	5-8	5-8	5-8	
C	188	0	188	0	0	5-8	5-8	5-8	

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	223	159/0	0/0	0/0	0/0	64/0	0/0
E	41	15/0	0/0	0/0	0/0	26/0	0/0
C	116	90/0	0/0	0/0	0/0	28/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	MAX. FACTORED FORCE (LBS)	CHORDS				MEMB.	MAX. FACTORED FORCE (LBS)	WEBS	
		VERT. LOAD (PLF)	CSH (LC)	MAX. UNBRACED LENGTH FR-TO	MAX. UNBRACED LENGTH FR-TO			CSH (LC)	MAX. UNBRACED LENGTH FR-TO
A-B	0/34	-91.8	-91.8	0.14 (5)	10.00	F-G	-121/9	0.00 (1)	
B-G	-18/0	-91.8	-91.8	0.04 (4)	8.25				
G-C	0/4	-91.8	-91.8	0.13 (1)	10.00				
C-D	-9/0	-91.8	-91.8	0.01 (1)	10.00				
B-F	0/0	-18.5	-18.5	0.11 (1)	10.00				
F-E	0/0	-18.5	-18.5	0.11 (1)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 12 = 35 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBCG 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPO 2011, TPO 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.14/1.00 (A-B-S), BC=0.11/1.00 (E-F-I), WB=0.00/1.00 (F-G-I), SS=0.11/1.00 (B-F-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1887 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.21 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006174

JOB NAME 408157	TRUSS NAME J3	QUANTITY 7	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 12:13:17 2020 Page 1
ID:7R4Dg_C9IAuIONuKpvt7nzzwO4-Gq1?D1Vda0H8ZtqG_wvofn4RQwWASp?pZZa1wXzQUhW

Scale = 1:15.3

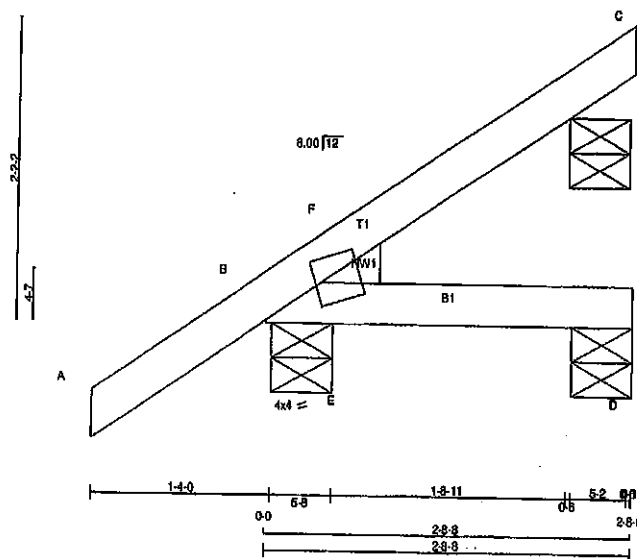

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.	SPF
A - C	2x4	DRY	No.2				
B - D	2x4	DRY	No.2				

DRY: SEASONED LUMBER.

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMBH1-m	M720	4.0	4.0	2.00	0.50

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD	HEEL
	GROSS REACTION	GROSS REACTION	BRG	BRG	WEDGE
	VERT	DOWN	IN-SX	IN-SX	
JT	103	0	0	0	
C	275	0	5-8	5-8	
B	47	0	5-8 (5-7)	5-8	2x4 L
D					

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
C	71	55/0	0/0	0/0	0/0	16/0	0/0
B	192	140/0	0/0	0/0	0/0	53/0	0/0
D	34	14/0	0/0	0/0	0/0	20/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LO)
FR-TO		FROM TO			FR-TO		
A-B	0/34	-91.8 -91.8	0.13 (5)	10.00	E-F	-93/0	0.00 (1)
B-F	-15/0	-91.8 -91.8	0.02 (4)	6.25			
F-C	0/4	-91.8 -91.8	0.08 (1)	10.00			
B-E	0/0	-18.5 -18.5	0.08 (1)	10.00			
E-D	0/0	-18.5 -18.5	0.08 (1)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 7 X 9 = 65 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2016

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.18")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.18")
CALCULATED VERT. DEFL. (TL) = L/999 (0.01")

CS: TC=0.13/1.00 (A-B-5), BC=0.08/1.00 (D-E-1), WB=0.00/1.00 (E-F-1), SS=0.09/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
	MAX	MIN	MAX
M720	818	354	1687

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.18 (B) (INPUT = 0.90)
JSI METAL=0.04 (B) (INPUT = 1.00)

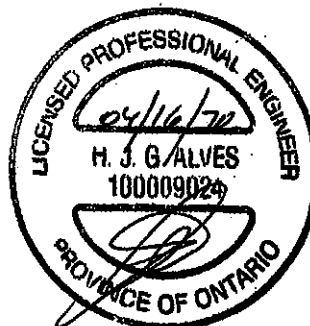


Structural component only
DWG# T-2006175

TRUSS DESC.

DRWG NO.

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Wed Apr 15 12:13:18 2020 Page 1
ID:7R4Dg_C9IAuiONuKplv?nzzhwO4-1t6CQMVLJP_B1OSYdQrC?cdEKJqGFyoDJaTzZQUHv
1-10-15
1-10-15 2-0-0

Scale = 1:17.6

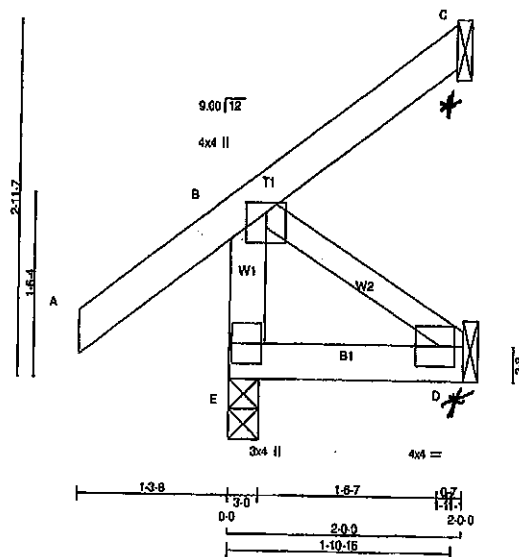

<u>PLATES (table is in inches)</u>						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV+p	MT20	4.0	4.0	1.00	2.00
D	BMWV-t	MT20	4.0	4.0	2.00	1.50
E	BMV1+p	MT20	3.0	4.0		

BEARINGS

JT	FACTORED		MAXIMUM FACTORED		INPUT	REQD
	GROSS REACTION		GROSS REACTION			
	VERT	HORZ	DOWN	HORZ	BRG	BRG
E	277	0	277	0	0	3-0
C	42	0	42	0	-35	1-8
D	18	0	20	0	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C-D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	193	145 / 0	0 / 0	0 / 0	0 / 0	48 / 0	0 / 0
C	29	23 / -25	0 / 0	0 / 0	0 / 0	5 / 0	0 / 0
D	14	0 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
E-B	-280.0	0.0	0.0	0.03 (1)	B-D	0.0	0.00 (1)
A-B	0.38	-91.8	-91.8	0.12 (1)			
B-C	-27.0	-91.8	-91.8	0.12 (1)			
E-D	0.0	-18.5	-18.5	0.02 (4)			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	8.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC-2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL(TL) = $L/360$ (0.19")

CALCULATED VERT. DEFL.(TL) = 1/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (B-D:1), SSI=0.08/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1858

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.21 (B) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006176

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408157	J5	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

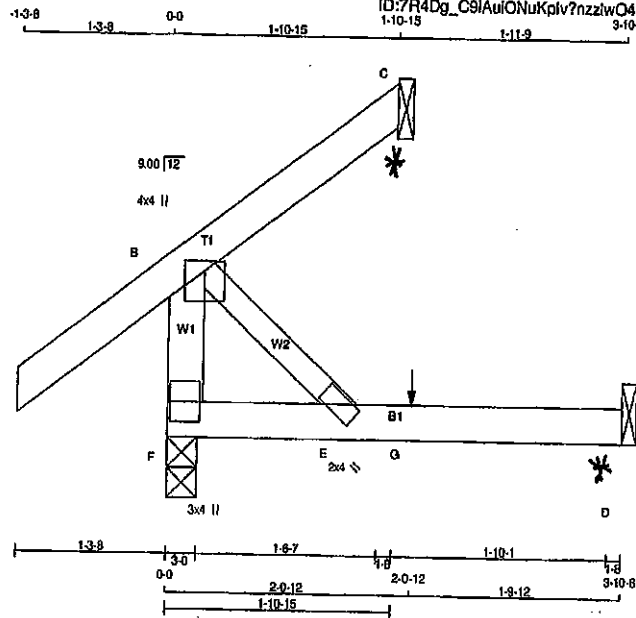

LUMBER			
N.L.G.A. RULES			
CHORDS	SIZE	DRY	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
E	BMVW+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

DESCR.	SPF	FACTORED		MAXIMUM FACTORED		INPUT	RECORD
		GROSS REACTION	HORZ	GROSS REACTION	DOWN	BRG	BRG
JT	SPF	VERT		DOWN		IN-SX	IN-SX
F	SPF	298	0	298	0	3-0	3-0
C	SPF	42	0	42	0	1-8	1-8
D	SPF	36	0	40	0	1-8	1-8

* SEE MTEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	COMBINED	MAX/MIN. COMPONENT REACTIONS					
		1ST LOOSE	SNOW	LIVE	PERM. LIVE	WIND	DEAD
F	208	145/0	0/0	0/0	0/0	0/0	63/0
C	29	23/-25	0/0	0/0	0/0	0/0	5/0
D	29	0/0	0/0	0/0	0/0	0/0	28/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (6)

MEMB.	MAX. FACTORED FORCE (LBS)	CHORDS				WEBS			
		FACTORED VERT. LOAD (PLF)	MAX. VERT. LOAD (LC1)	MAX. HORZ. LOAD (LC1)	MAX. HORZ. LOAD (LC1)	FACTORED FORCE (LBS)	MAX. FORCE (LBS)	MAX. HORZ. LOAD (LC1)	MAX. HORZ. LOAD (LC1)
FR-TO		FROM	TO	FROM	TO	FR-TO		FR-TO	
F-B	-260/0	0.0	0.0	0.03 (1)	7.61	B-E	0/0	0.00 (1)	
A-B	0/38	-91.8	-91.8	0.14 (5)	10.00				
B-C	-27/0	-91.8	-91.8	0.18 (5)	8.25				
F-E	0/0	-18.5	-18.5	0.08 (4)	10.00				
E-G	0/0	-18.5	-18.5	0.08 (4)	10.00				
G-D	0/0	-18.5	-18.5	0.08 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	2-0-12	1	1	---	BACK	VERT	TOTAL	---	CI

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 12 = 36 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. G/G

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.01")

CSI: TC=0.14/1.00 (A-B-5), BC=0.08/1.00 (D-E-4), WB=0.00/1.00 (B-E-1), SS=0.09/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PS)	(PL)	(PL)
	MAX	MIN	MAX
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.21 (B) (INPUT = 0.90)
JSI METAL=0.05 (B) (INPUT = 1.00)

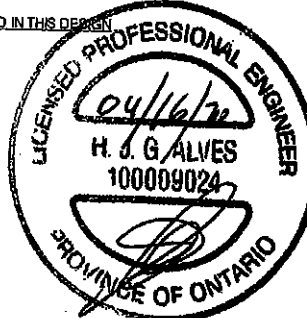


Structural component only
DWG# T-2006177

JOB NAME 408157	TRUSS NAME J6	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 12:13:20 2020 Page 1
ID:7R4Dg_C8lAuIOnuKplv?nzzlwO4-hPI8r2XWbfQLYqf2SJHQk08YpIAIFFXohXszQUhT

Scale = 1:24.8

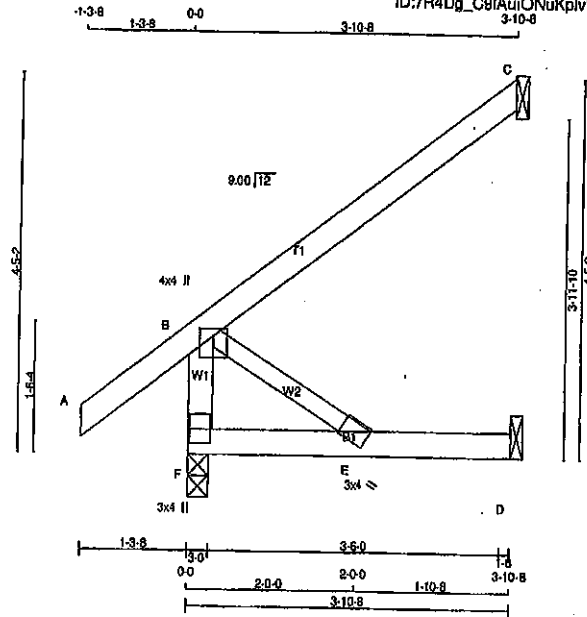

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (Labels in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
E	BMVW+w	MT20	3.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
JT	GROSS REACTION	DOWN	GROSS REACTION	BRG	BRG
F	340	0	340	0	3-0
C	178	0	178	0	1-8
D	36	0	40	0	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN.	COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	238	170/0	0/0	0/0	0/0	0/0	0/0	69/0	0/0
C	122	99/0	0/0	0/0	0/0	0/0	0/0	23/0	0/0
D	29	0/0	0/0	0/0	0/0	0/0	0/0	29/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (6)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM	TO		FR-TO		
F-B	-304/0	0.0	0.0	0.03 (1)	7.81	B-E	0/0
A-B	0/38	-91.8	-91.8	0.14 (5)	10.00		.00 (1)
B-C	0/0	-91.8	-91.8	0.23 (1)	10.00		
F-E	0/0	-18.5	-18.5	0.08 (4)	10.00		
E-D	0/0	-18.5	-18.5	0.08 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 15 = 45 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 W/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.23/1.00 (B-C:1), BC=0.08/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SSI=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1667 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP = 0.24 (B) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006178

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408158	J20	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

ID:7R4Dg_C9IAuIONuKplv7nzlwO4-al6wEV_J_hKXCmKl.6tyx48dQCChTHs(fz3WzUnzQSA

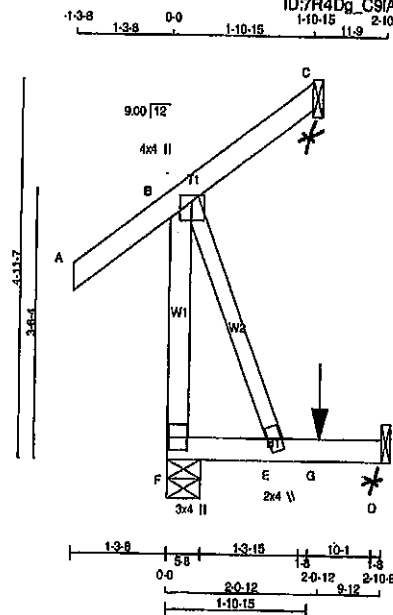

Scale = 1:27.8

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4 DRY	No.2	SPF		
A - C	2x4 DRY	No.2	SPF		
F - D	2x4 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
DRY SEASONED LUMBER.					

PLATES (Table 1g in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
E	BMW+w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
	DOWN	UP	IN-SX	IN-SX
JT	288	0	5-8	5-8
F	42	0	1-8	1-8
C	31	0	1-8	1-8
D				

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) G, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS	1ST LOASE	MAX/MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	202	145 / 0	0 / 0	0 / 0	0 / 0	57 / 0	0 / 0
F	29	23 / -25	0 / 0	0 / 0	0 / 0	5 / 0	0 / 0
C	25	0 / 0	0 / 0	0 / 0	0 / 0	25 / 0	0 / 0
D							

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 MAX (PLF)	CSI (LC)	MEMB. FORCE (LBS)
FR-TO		FROM TO	LENGTH	FR-TO
F-B	-280 / 0	0.0	0.05 (1)	7.81
A-B	0 / 38	-91.8	-91.8 0.14 (5)	10.00
B-C	-27 / 0	-91.8	-91.8 0.13 (5)	6.25
F-E	0 / 0	-18.5	-18.5 0.05 (4)	10.00
E-G	0 / 0	-18.5	-18.5 0.05 (4)	10.00
G-D	0 / 0	-18.5	-18.5 0.05 (4)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	2-0-12	-8	-8	-8	BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 14 = 28 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 089-09, CSA 086-14
- TPC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CSI: TC=0.14/1.00 (A-B-5), BC=0.05/1.00 (D-E-4),
WB=0.00/1.00 (B-E-1), SS=0.08/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1897 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)

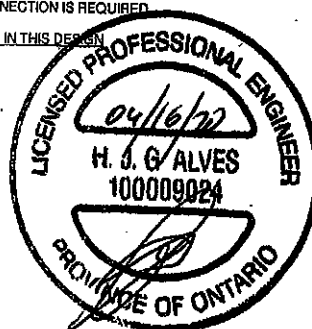

Structural component only
DWG# T-2006195


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408158	J21	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

ID:7R4Dq_C9IAuIOnuKplv7nzzlwO4-24gIRr?xl?SOQwJXgaUAdJAc4pobiv6HAIQ0DzQSArn

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 15:04:45 2020 Page 1

Scale = 1:27.7

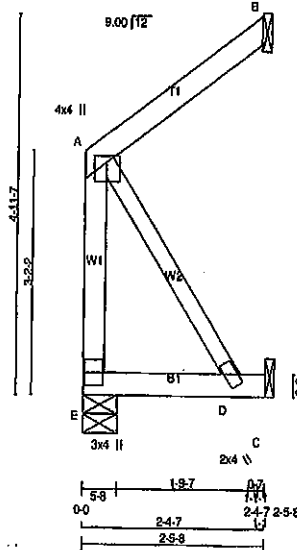

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
E - A	2x4	DRY	No.2
A - B	2x4	DRY	No.2
E - C	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW+p	MT20	4.0	4.0	1.00 2.00
D	BMVW+w	MT20	2.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERT	HORZ	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
E	131	0	0	131	0	0	5-8	5-8	
B	109	0	0	109	0	0	1-8	1-8	
C	23	0	0	25	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
E	93	81/0	0/0	0/0	0/0
B	75	81/0	0/0	0/0	0/0
C	18	0/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM	TO	FR-TO			
E-A	-109/0	0.0	0.0 0.02 (1)	A-D	0/0	0.00 (1)	
A-B	0/0	-91.8	-91.8 0.09 (1)				
E-D	0/0	-18.5	-18.5 0.03 (4)				
D-C	0/0	-18.5	-18.5 0.02 (4)				

TOTAL WEIGHT = 2 X 12 = 24 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.09/1.00 (A-B:1), BC=0.03/1.00 (D-E:4),
WB=0.00/1.00 (A-D:1), SS=0.07/1.00 (A-B:1)

OOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.00 (A) (INPUT = 0.99)
JSI METAL = 0.02 (A) (INPUT = 1.00)



Structural component only
DWG# T-2006196

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408158	J22	6	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 28 2019 Mitek Industries, Inc. Wed Apr 15 15:04:45 2020 Page 1					
ID:7R4Dg_C9IAuIONuKpLv7nzzlwO4-24gIRr?xl?SOQwXgaUAdJAb24pccbtv6HAJQ0DzQSAm					

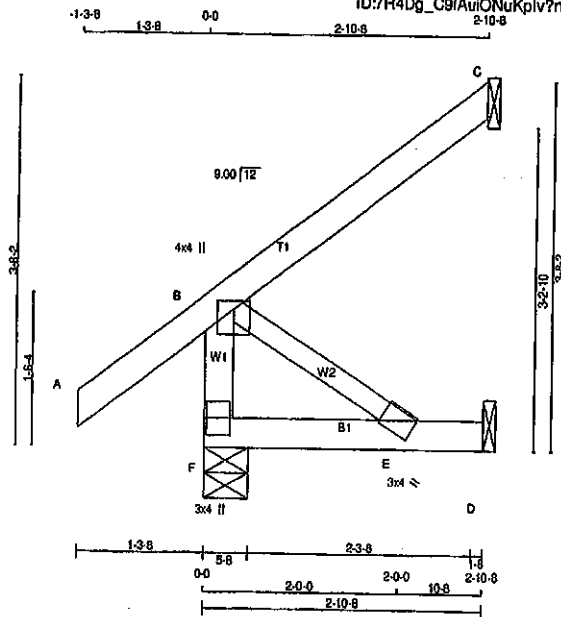

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
E	BMVW+p	MT20	3.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG	IN-SX
JT	VERT	DOWN	HORIZ	UPLIFT
F	285	0	285	0
C	132	0	132	0
D	27	0	30.	0

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOSE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	159	144 / 0	0 / 0	0 / 0	0 / 0	55 / 0	0 / 0
C	91	74 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	21	0 / 0	0 / 0	0 / 0	0 / 0	21 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LO1 (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
F-B	-258 / 0	0.0 0.0 0.03 (1)	B-E	0 / 0
A-B	0 / 38	-91.8 -91.8 0.13 (5)		
B-C	0 / 0	-91.8 -91.8 0.13 (1)		
F-E	0 / 0	-18.5 -18.5 0.04 (4)		
E-D	0 / 0	-18.5 -18.5 0.04 (4)		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 8 X 12 = 75 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.8	PSF
	DL =	8.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/800$ (0.19')
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00')
ALLOWABLE DEFL. (TL) = $L/800$ (0.19')
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00')

CSI: TC=0.13/1.00 (A-B:5), BC=0.04/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SS=0.08/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	616 354	1667 789

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006197

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408159	J31	6	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

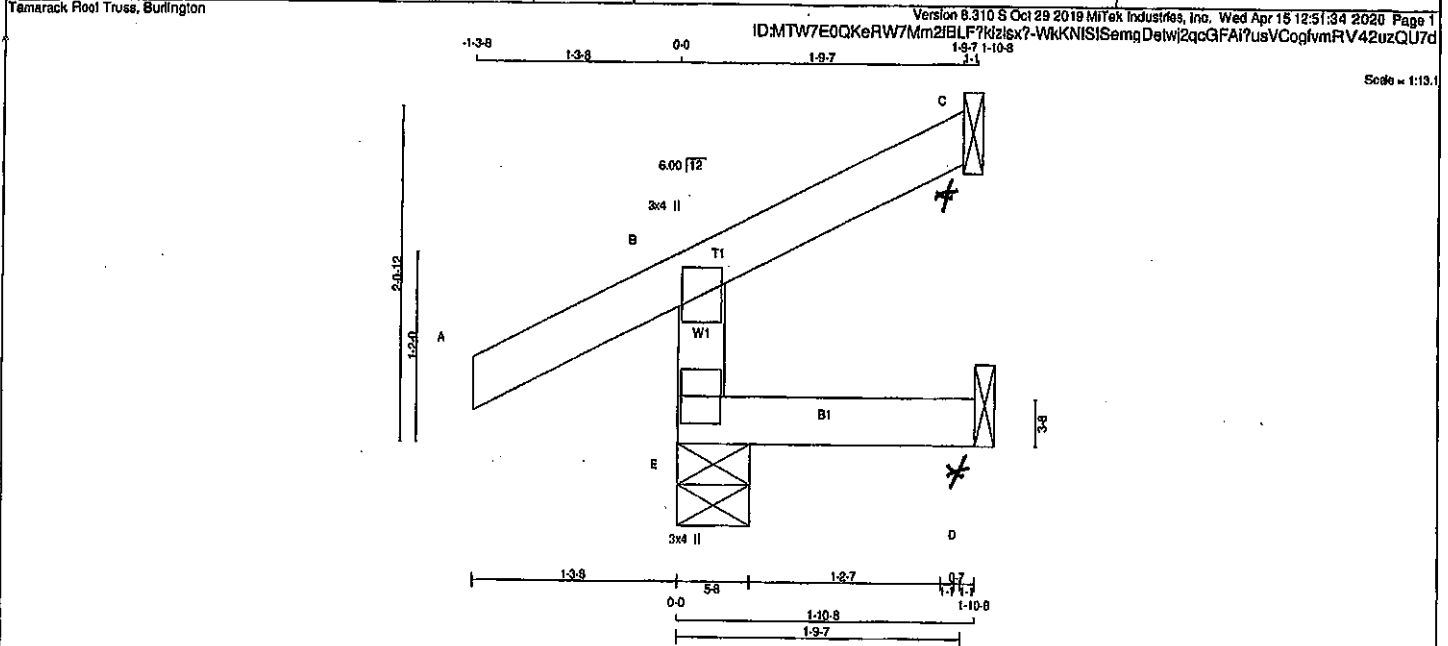

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER
E - B 2x4 DRY No.2
A - C 2x4 DRY No.2
E - D 2x4 DRY No.2

DRY, SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV4p	MT20	3.0	4.0		
E BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER								
<u>BEARINGS</u>								
DESCR.	SPF	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG
	SPF	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SY
	SPF							IN-SY

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	188	141 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0
C	31	24 / -18	0 / 0	0 / 0	0 / 0	7 / 0	0 / 0
D	7	0 / -8	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS				WEBS				
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FORCE (LBS)	FACTORED MAX. CSI (LC)
FR-TO		FROM	TO			FR-TO		
E-B	-244 / 0	0.0	0.0	0.04 (5)	7.81			
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00			
B-C	-17 / 0	-91.8	-91.8	0.09 (1)	6.25			
E-D	0 / 0	-18.5	-18.5	0.04 (5)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 6 X 7 = 42 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2016, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/380 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5),
WB=0.00/1.00 (Va:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1807 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)

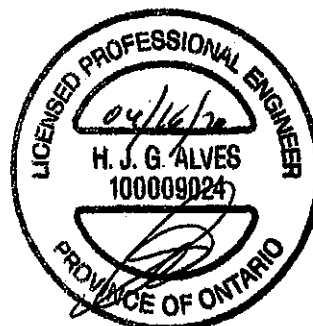

Structural component only
DWG# T-2006204

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408159	J32	5	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Wed Apr 15 12:51:35 2020 Page 1					
ID:MTW7E0QKeRW7Mm2IBLF?kizlsx?-wulWoJSP4o4G1VwcY7VoOF80GrmX7u2_4EdaKzQLU7c					
Scale = 1:18.2					

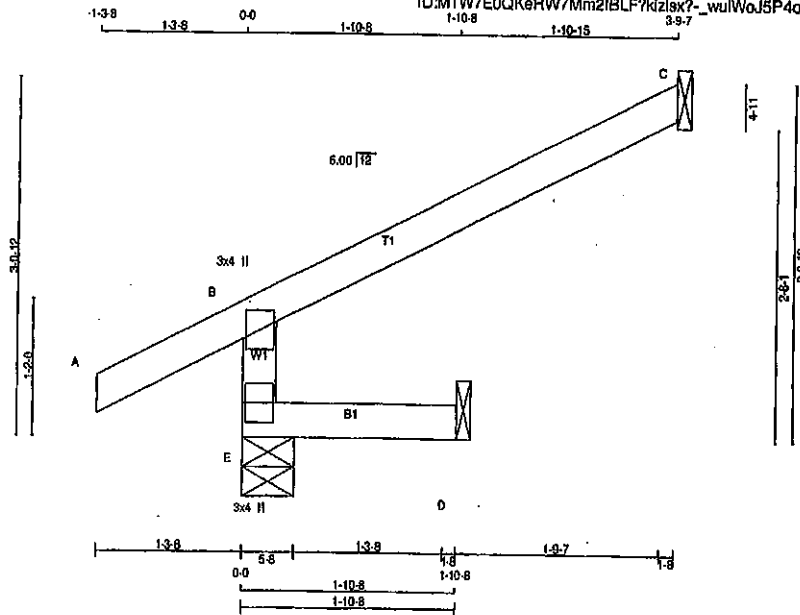

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
E	BMV+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQ'D BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	381	0	381	0	5-8	5-8
C	130	0	130	0	1-8	1-8
D	16	0	17	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

JT	UNFACTORED REACTIONS		MAX./MIN. COMPONENT REACTIONS				WIND	DEAD	SOIL
	1ST LCASE	SNOW	LIVE	PERM	LIVE	WIND			
E	250	190/0	0/0	0/0	0/0	60/0	0/0	0/0	0/0
C	90	73/0	0/0	0/0	0/0	17/0	0/0	0/0	0/0
D	12	0/0	0/0	0/0	0/0	12/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

MEMB.	CHORDS		WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 MAX. (PLF)	MAX. UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED (LBS)
FR-TO		FROM TO				
E-B	-342/0	0.0	0.0	0.01 (4)	7.81	
A-B	0/28	-91.8	-91.8	0.13 (5)	10.00	
B-C	-19/0	-91.8	-91.8	0.22 (1)	6.25	
E-D	0/0	-18.5	-18.5	0.02 (4)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBCG 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, USA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.14 (B) (INPUT = 0.90)
JSI METAL= 0.03 (B) (INPUT = 1.00)

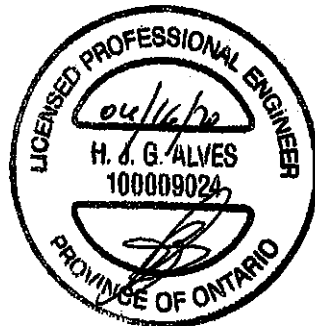


Structural component only
DWG# T-2006205

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408159	J33	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 12:51:37 2020 Page 1
ID:MTW7E0QKeRW7Mm2IBLF7Kzlsx?-xJ?VxTKLwh3oVLfjzAztbKW74UL?1OLSO]kIdzQU7a
5-10-8

Scale = 1:12.7

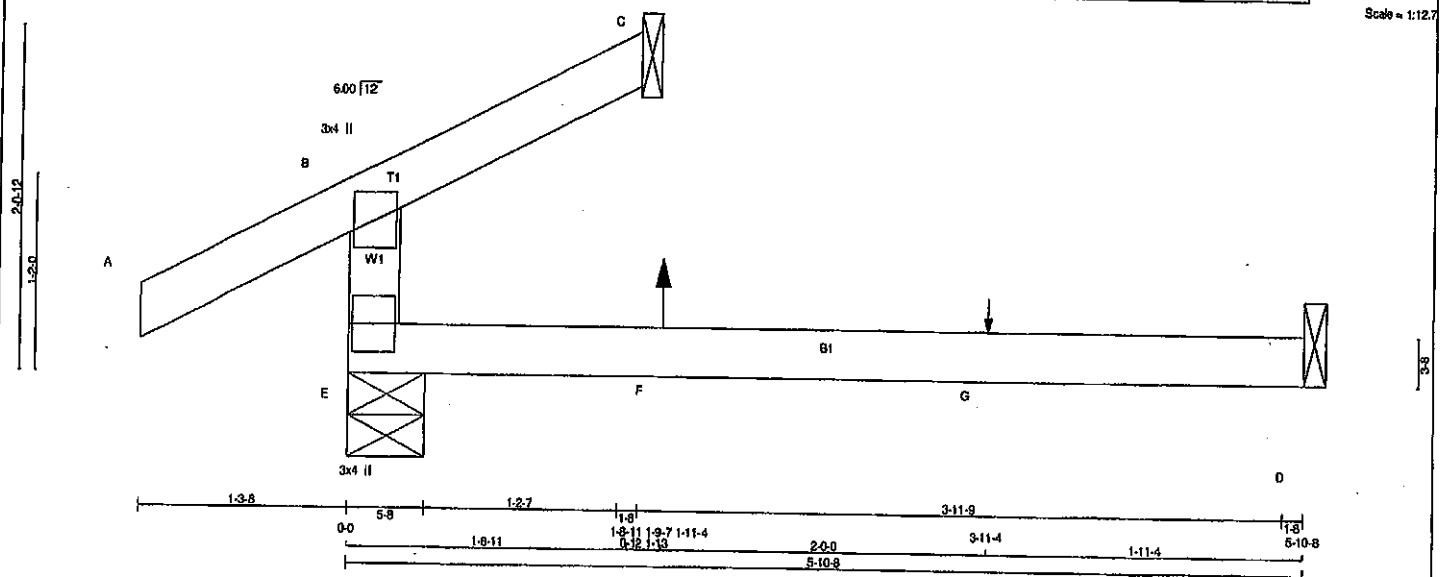

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE		LUMBER	DESCR.
E - B	2x4	DRY	No.2		SPF
A - C	2x4	DRY	No.2		SPF
E - D	2x4	DRY	No.2		SPF
DRY: SEASONED LUMBER.					

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
JT	VERT	HORZ	UPLIFT	IN-SX
E	284	0	284	0
C	63	0	63	0
D	44	0	52	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED						
E	200	137 / 0	0 / 0	0 / 0	0 / 0	62 / 0	0 / 0
C	46	21 / 0	0 / 0	0 / 0	0 / 0	25 / 0	0 / 0
D	35	0 / 3	0 / 0	0 / 0	0 / 0	37 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (7)

CHORDS			WEBS		
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLP)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO	UNBRAC LENGTH	FR-TO	MAX CSI (LC)
E-B	-227 / 0	0.0 0.0	0.11 (4) 7.81		
A-B	0 / 28	-91.8 -91.8	0.12 (1) 10.00		
B-C	-9 / 9	-91.8 -91.8	0.08 (4) 10.00		
E-F	0 / 0	-18.5 -18.5	0.14 (4) 10.00		
F-G	0 / 0	-18.5 -18.5	0.14 (4) 10.00		
G-D	0 / 0	-18.5 -18.5	0.14 (4) 10.00		

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11.4	7	1	12	FRONT	VERT	TOTAL	---	---	C1
G	3-11.4	1	1	---	FRONT	VERT	TOTAL	---	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:	TOP CH.	LL	PSF
	DL	=	25.6
	DL	=	6.0
	DL	=	0.0
	DL	=	7.4
	TOTAL LOAD	=	39.0

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCG 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4), WB=0.00/1.00 (N/A:0), SS=0.08/1.00 (A-B:1)

DOL LUMBER=0.99 NAIL=0.99 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES	PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)	(PLI)
	MAX	MIN	MAX	MIN
	MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006205

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408159	J34	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 12:51:38 2020 Page 1
ID:MTW7E0QKRW7Mm2fBLF7klz/sx7-PVZl8pLzh7B7VEVHghCQ0fFTqgkUeVg2TlBfzQU7Z

Scale = 1:17.7

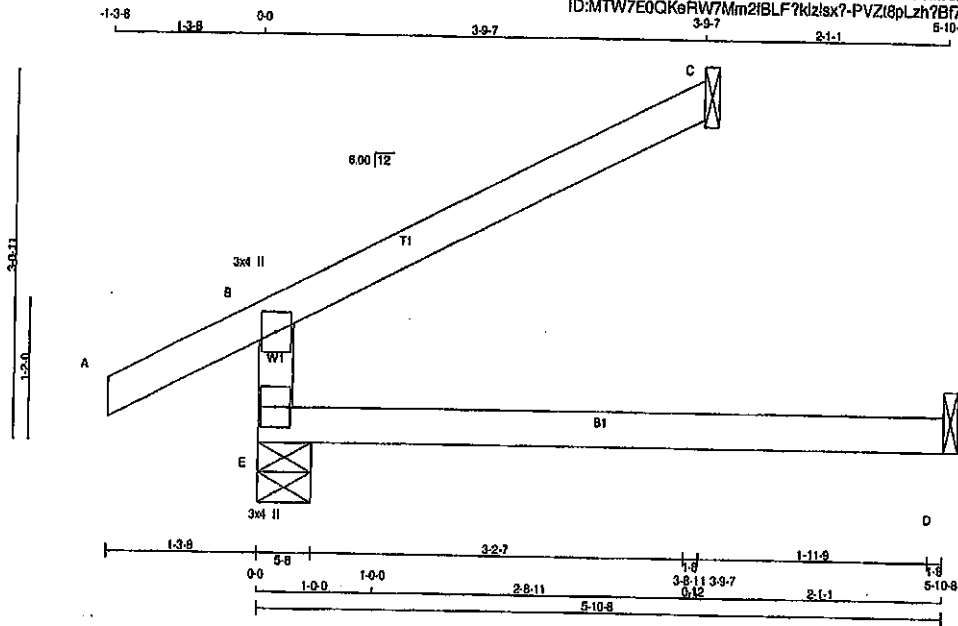

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	SPF
A - C	2x4	DRY	SPF
E - D	2x4	DRY	SPF

DRY: SEASONED LUMBER.

PLATES (plates in inches)			
JT TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0 4.0
E	BMV1+p	MT20	3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQ'D BRG
	VERT	HORZ	DOWN	HORZ		
JT					IN-SX	IN-SX
E	405	0	405	0	5-8	5-8
C	130	0	130	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN COMPONENT REACTIONS					
		COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
E	288	190 / 0	0 / 0	0 / 0	0 / 0	98 / 0	0 / 0
C	90	73 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	38 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

FR-TO	CHORDS		FACTORED		WEBS	
	MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. CS (LC)	MEMB.	FORCE (LBS)
E-B		-342 / 0	0.0	0.0 0.13 (4)		7.81
A-B		0 / 28	-91.8	-91.8 0.12 (1)		10.00
B-C		-19 / 0	-91.8	-91.8 0.22 (1)		8.25
E-D		0 / 0	-18.5	-18.5 0.13 (4)		10.00

DESIGN CRITERIA

SPECIFIED LOADS:		
TOP CH. LL	=	25.6 PSF
DL	=	6.0 PSF
BOT CH. LL	=	0.0 PSF
DL	=	7.4 PSF
TOTAL LOAD	=	39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.03")

CS: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (A-B:0), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP (DRY)	SHEAR	SECTION
	(PS)	(PL)	(PL)
	MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1687 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

SI GRIP=0.14 (E) (INPUT = 0.90)
SI METAL=0.09 (B) (INPUT = 1.00)

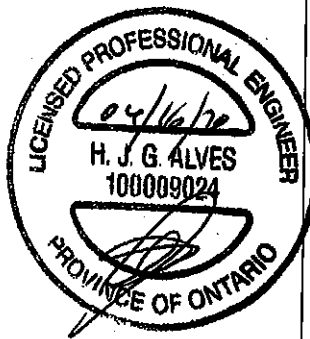


Structural component only
DWG# T-2006207

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408159	J35	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 12:51:39 2020 Page 1
ID:MTW7E0QKerW7Mm2IBLF7kdex7-i7GM9MbSIJvkeohrNCRyEPatCyTxuaviCrj8zQU7Y

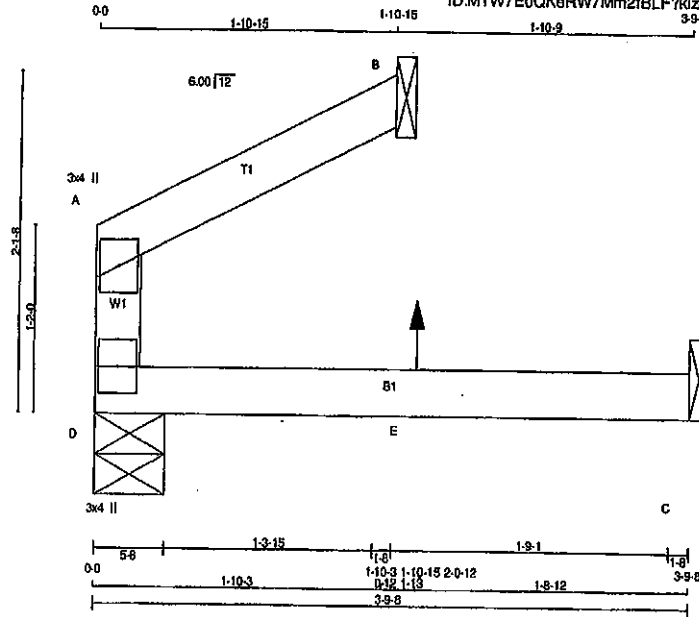

Scale = 1:12.5

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
D - A	2x4	DRY	No.2	SPF	
A - B	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0			
D	BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	UPLIFT
D	119	0	119	0
B	89	0	89	0
C	31	0	35	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B, C

UNFACTORED REACTIONS	1ST LOASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	COMBINED						
D	88	49/0	0/0	0/0	0/0	37/0	0/0
B	62	45/0	0/0	0/0	0/0	17/0	0/0
C	25	0/2	0/0	0/0	0/0	25/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D, B

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (7)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1	MAX. CS1 (LC)	MAX. FORCE (LBS)
FR-TO		FROM TO	LENGTH FR-TO	
D-A	-97/0	0.0	0.0 (4)	7.81
A-B	0/3	-91.8	-91.8 (1)	10.00
D-E	0/0	-18.5	-18.5 (4)	10.00
E-C	0/0	-18.5	-18.5 (4)	10.00

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
E	2-0-12	7	1	12	BACK	VERT	TOTAL			C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.16")
CALCULATED VERT. DEFL.(LL) = L/889 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.16")
CALCULATED VERT. DEFL.(TL) = L/889 (0.01")

CSI: TO=0.08/1.00 (A-B:1), BC=0.08/1.00 (C-D:4), WB=0.00/1.00 (n/a:0), SSI=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.04 (D) (INPUT = 0.90)
JSI METAL = 0.02 (A) (INPUT = 1.00)

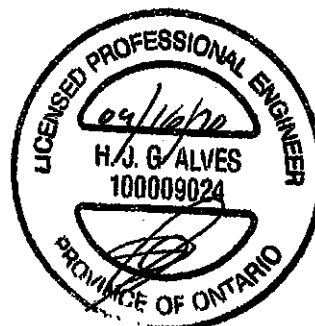

Structural component only
DWG# T-2006208

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408159	J38	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

ID:MTW7E0QKaRW7Mm2IBLF?kizlsx?-LuheZVMDDcRMMnO5jgVRy0NHXjCO8n8MyOGYzQU7X
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 12:51:40 2020 Page 1
1-10-15 4-11-8

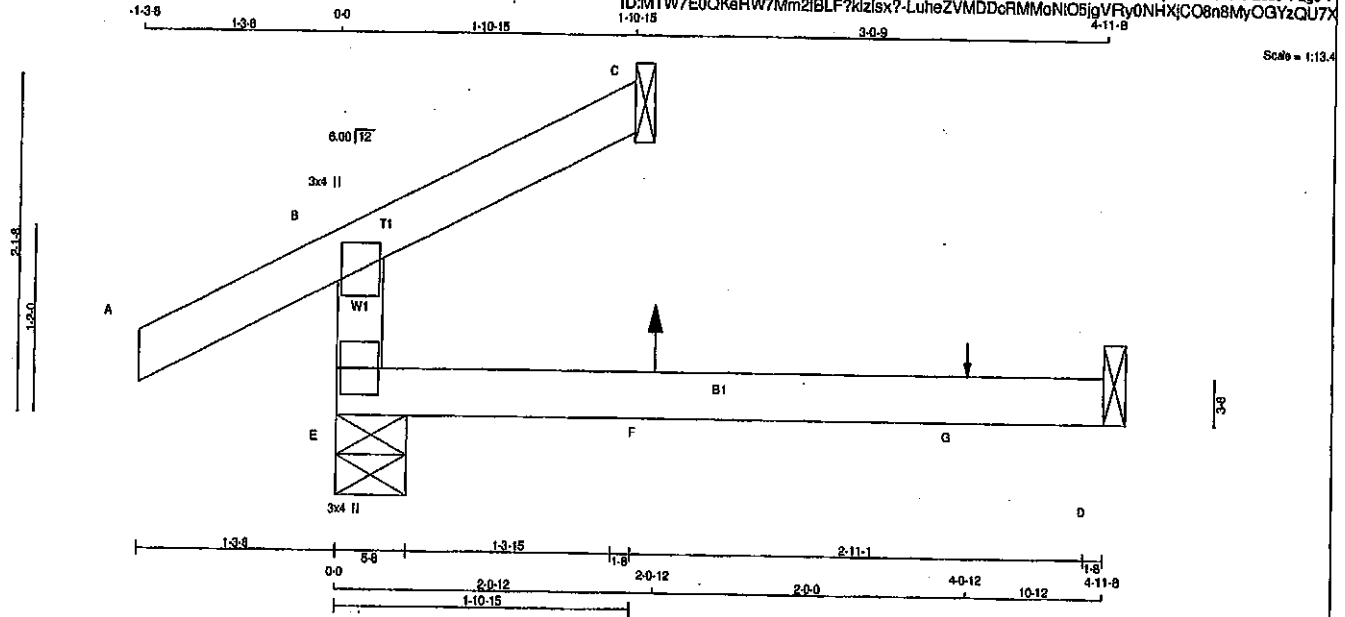

Scale = 1:13.4

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (thickness in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0			
E	BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
E	282	0	282	0
C	66	0	66	0
D	36	0	43	0

SEE MITEK STANDARD DETAIL B87791H FOR CONNECTION TO JOINT(S) E, D

UNFACTORED REACTIONS	1ST CASE	MAX/MIN	COMPONENT REACTIONS
	COMBINED	SNOW	LIVE
E	200	127 / 0	0 / 0
C	46	37 / 0	0 / 0
D	29	0 / 2	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (7)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. UNBRACED LENGTH	MEMB. FORCE (LBS)
FR-TO		FROM TO		FR-TO
E-B	-234 / 0	0.0	0.0	0.09 (4)
A-B	0 / 28	-91.8	-91.8	0.12 (1)
B-C	-10 / 0	-91.8	-91.8	0.06 (1)
E-F	0 / 0	-18.5	-18.5	0.09 (4)
F-G	0 / 0	-18.5	-18.5	0.09 (4)
G-D	0 / 0	-18.5	-18.5	0.09 (4)

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	2-0-12	7	1	12	BACK	VERT	TOTAL	--	C1	
G	4-0-12	1	1	--	BACK	VERT	TOTAL	--	C1	

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.02")

CSI: TC=0.12/1.00 (A-B:1), BC=0.09/1.00 (D-E:4), WB=0.00/1.00 (VA:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	
MAX	MIN	MAX	MIN
MT20	618	364	1867

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

SI GRIP= 0.10 (E) (INPUT = 0.90)
SI METAL= 0.08 (B) (INPUT = 1.00)

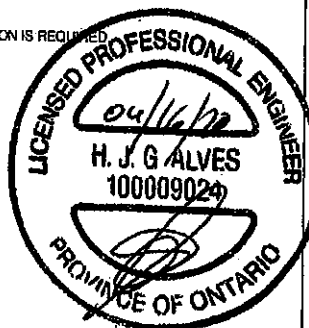

Structural component only
DWG# T-2006209

JOB NAME 408159	TRUSS NAME J39	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

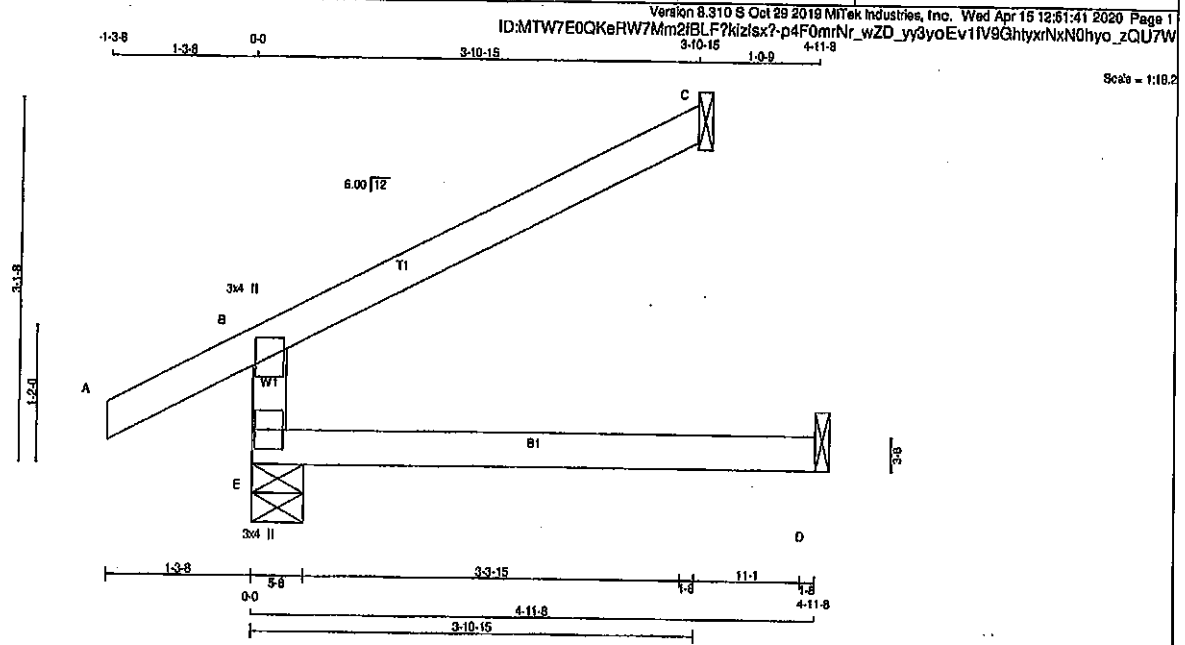

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY, SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
E BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	402	0	402	0	5-8	5-8
C	135	0	135	0	1-8	1-8
D	38	0	43	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97781H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX/MIN COMPONENT REACTIONS				
		SNOW	LIVE	PERM LIVE	WIND	DEAD
E	283	194/0	0/0	0/0	0/0	88/0
C	93	75/0	0/0	0/0	0/0	18/0
D	31	0/0	0/0	0/0	0/0	31/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

FR-TO	CHORDS		FACTORED		WEBS	
	MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CS1 (LC)	MEMB.	FORCE (LBS)
E-B		-349/0	0.0	0.0		7.81
A-B		0/28	-91.8	-91.8		10.00
B-C		-20/0	-91.8	-91.8		6.25
E-D		0/0	-18.5	-18.5		10.00

TOTAL WEIGHT = 2 X 13 = 26 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
CL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPOC 2011, TPOC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TO=0.24/1.00 (B-C:1), BC=0.09/1.00 (D-E:4), WB=0.00/1.00 (N/A:0), SSI=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.15 (E) (INPUT = 0.90)
JSI METAL= 0.10 (B) (INPUT = 1.00)

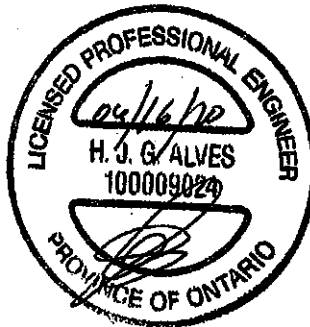

JOB NAME 408159	TRUSS NAME J41	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 6.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 15 12:51:42 2020 Page 1
ID:MTW7E0QKRW7Mm2iBLF7Kizlsx7-HHpO_BOUDH4b6XGWWi8as1lv5A_gld4bgRVKQzQU7V

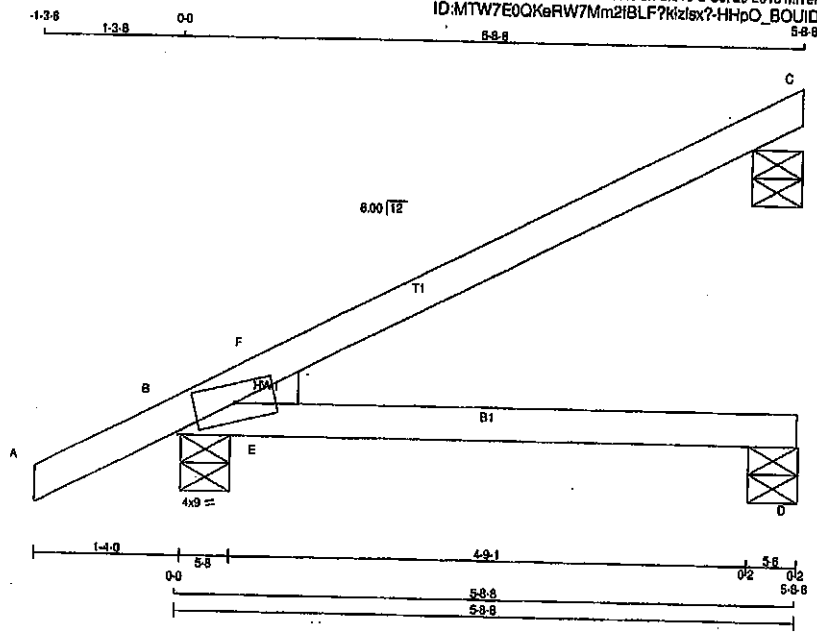

Scale = 1:19.0

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER
A - C 2x4 DRY No.2
B - D 2x4 DRY No.2
DRY: SEASONED LUMBER.

PLATES (table is in inches)
JT TYPE PLATES W LEN Y X
B TMBH1-m MT20 4.0 9.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECORD BRG IN-SX	HEEL WEDGE
	VERT	HORZ	DOWN	HORZ			
C	225	0	225	0	5-8 (5-7)	5-8	
B	439	0	439	0	5-8	5-8	2x4 L
D	90	0	90	0	5-8 (5-5)	5-8	

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

REVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
C	158	121/0	0/0	0/0	0/0	35/0	0/0
B	308	215/0	0/0	0/0	0/0	93/0	0/0
D	67	25/0	0/0	0/0	0/0	42/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)
FR-TO		FROM TO			FR-TO		
A-B	0/26	-91.8 -91.8	0.12 (1)	10.00	E-F	-254/6	0.00 (1)
B-F	-22/0	-91.8 -91.8	0.08 (4)	8.25			
F-C	0/4	-91.8 -91.8	0.37 (1)	10.00			
B-E	0/0	-18.5 -18.5	0.30 (1)	10.00			
E-D	0/0	-18.5 -18.5	0.30 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ASO 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.18")
CALCULATED VERT. DEFL.(LL) = L/998 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (0.18")
CALCULATED VERT. DEFL.(TL) = L/500 (0.14")

CSI: TC=0.37/1.00 (C-F:1), BC=0.30/1.00 (B-E:1), WB=0.00/1.00 (E-F:1), SS=0.21/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1887 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (B) (INPUT = 0.90)
JSI METAL= 0.03 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006211

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, a) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.


Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.

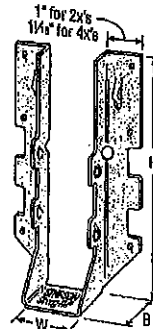


LUS28




LU26L

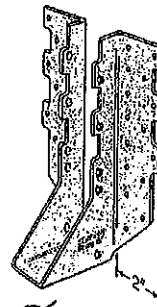

HUS210
(HUS26, HUS28,
and HHUS similar)




HGUS28-2



HHUS210-2



Double-Shear
Nailing
Top View





Double-Shear
Nailing
Side View;
Do not
bend tab



Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,803,580

Typical HUS28
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

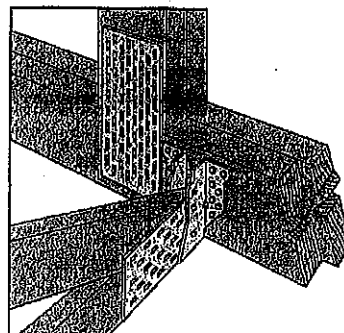

LJS26DS

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**SIMPSON**
Strong-Tie®**HHUS/HGUS**

See Hanger Options information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value



Top View HHUS Hanger Skewed Right
(joist must be bevel cut)
All joist nails installed on the outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ^a	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN	(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN
Single 2x Sizes											
LUS24	18	1 1/8	3 3/4	1 1/4	2 1/4	(4) 10d	(2) 10d	710 3.16	1626 7.23	645 2.87	1155 5.14
LU24L	22	1 1/8	3	1 1/4	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360 1.60	1020 4.54	320 1.42	725 3.22
LU26L	22	1 1/8	5	1 1/4	4 1/4	(6) 10d	(4) 10d x 1 1/2"	720 3.20	1605 7.14	645 2.87	1140 5.07
LUS26	18	1 1/8	4 1/4	1 1/4	3 3/4	(4) 10d	(4) 10d	1420 6.32	2170 9.66	1290 5.74	1630 7.25
HUS26	16	1 1/8	5 3/4	3	3 1/8	(14) 16d	(6) 16d	2705 11.80	4940 21.97	2065 9.20	3675 17.24
LJS26DS	18	1 1/8	5	3 1/2	4 1/4	(16) 16d	(6) 16d	2055 9.14	4265 18.97	1460 6.49	4115 18.31
HGUS26	12	1 1/8	5 3/4	5	4 1/4	(20) 16d	(8) 16d	2685 11.96	6625 29.51	2685 11.96	5700 25.35
LU28L	20	1 1/8	6 3/4	1 1/4	5 1/4	(8) 10d	(6) 10d x 1 1/2"	1140 5.07	2185 9.72	1020 4.54	1550 6.89
LUS28	18	1 1/8	6 3/4	1 1/4	3 3/4	(6) 10d	(4) 10d	1420 6.32	2520 11.21	1290 5.74	1790 7.96
HUS28	16	1 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3605 16.04	5365 23.88	2675 11.90	4345 19.33
HGUS28	12	1 1/8	7 1/8	5	6 1/4	(36) 16d	(12) 16d	3310 14.74	7675 34.19	3310 14.74	6900 30.73
LU210L	20	1 1/8	8	1 1/4	7 1/4	(10) 10d	(6) 10d x 1 1/2"	1140 5.07	2495 11.10	1020 4.54	1770 7.87
LUS210	18	1 1/8	7 1/8	1 1/4	3 3/4	(8) 10d	(4) 10d	1420 6.32	2785 12.39	1290 5.74	2210 9.83


1. Factored uplift resistances have been increased 16% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance					
		W	H	B	d _h ³	Header	Joist	D.Fir-L		S-P-F			
								Uplift	Normal	Uplift	Normal		
								(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN	(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN		
Double 2x Sizes													
LUS24-2	18	3 1/8	3 1/8	2	1 1/2	(4) 10d	(2) 16d	835 3.71	2020 8.99	590 2.62	1435 6.38		
LUS26-2	18	3 1/8	4 1/8	2	4	(4) 10d	(4) 16d	1720 7.65	2595 11.54	1545 6.87	1920 8.64		
HHUS26-2	14	3 1/8	5 1/8	3	3 1/8	(14) 10d	(8) 16d	2850 12.68	7335 32.83	2065 9.20	5205 23.15		
HGUS26-2	12	3 1/8	5 1/8	4	4 1/8	(20) 10d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27		
LUS28-2	18	3 1/8	7	2	4	(6) 10d	(4) 16d	1720 7.65	3325 14.79	1545 6.87	2575 11.45		
HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 10d	(8) 16d	3765 16.75	8940 39.77	2675 11.90	6345 28.22		
HGUS28-2	12	3 1/8	7 1/8	4	6 1/8	(36) 10d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99		
LUS210-2	18	3 1/8	9	2	6	(8) 10d	(6) 16d	2580 11.48	4500 20.02	2320 10.32	3195 14.21		
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 10d	(10) 16d	4670 20.77	9660 42.97	4235 18.84	7000 31.14		
HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(46) 10d	(16) 16d	6840 30.43	14015 62.34	4855 21.60	10270 45.69		
Triple 2x Sizes													
HGUS26-3	12	4 1/8	5 1/2	4	4 1/8	(20) 10d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27		
HGUS28-3	12	4 1/8	7 1/4	4	6 1/8	(36) 10d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99		
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 10d	(10) 16d	4670 20.77	9670 43.02	4235 18.84	6865 30.54		
HGUS210-3	12	4 1/8	9 1/4	4	8 1/8	(46) 10d	(16) 16d	6840 30.43	14645 65.14	4855 21.60	10400 46.26		
Quadruple 2x Sizes													
HGUS26-4	12	6 1/8	5 1/8	4	4 1/8	(20) 10d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27		
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 10d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99		
HHUS210-4	14	8 1/8	8 1/8	3	7 1/8	(30) 10d	(10) 16d	4670 20.77	10165 45.17	4235 18.84	7210 32.07		
HGUS210-4	12	6 1/8	9 1/8	4	8 1/8	(46) 10d	(16) 16d	6840 30.43	14645 65.14	4855 21.60	10400 46.26		
HGUS212-4	12	6 1/8	10 1/8	4	10 1/8	(56) 10d	(20) 16d	7640 33.98	14995 66.70	5425 24.13	10645 47.35		
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 10d	(22) 16d	10130 45.06	16400 72.95	7195 32.00	11645 51.80		
4x Sizes													
LUS46	18	3 3/8	4 3/4	2	3 3/8	(4) 10d	(4) 16d	1720 7.65	2595 11.54	1545 6.87	1920 8.64		
HHUS46	14	3 3/8	5 1/4	3	3 3/8	(14) 10d	(6) 16d	2540 11.30	7335 32.83	2065 9.20	5205 23.15		
HGUS46	12	3 3/8	5 1/4	4	4 1/8	(20) 10d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27		
LUS48	18	3 3/8	6 3/4	2	3 3/8	(6) 10d	(4) 16d	1720 7.65	3325 14.79	1545 6.87	2575 11.45		
HHUS48	14	3 3/8	7 1/8	3	6 1/8	(22) 10d	(8) 16d	3765 16.75	8940 39.77	2675 11.90	6345 28.22		
HGUS48	12	3 3/8	7 1/8	4	6 1/8	(36) 10d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99		
LUS410	18	3 3/8	8 3/4	2	5 1/8	(8) 10d	(6) 16d	2580 11.48	4500 20.02	2320 10.32	3195 14.21		
HGUS410	12	3 3/8	9	4	8 1/8	(46) 10d	(16) 16d	6840 30.43	14015 62.34	4855 21.60	10270 45.69		
HGUS412	12	3 3/8	10 1/8	4	10 1/8	(56) 10d	(20) 16d	7640 33.98	14995 66.70	5425 24.13	10645 47.35		
HGUS414	12	3 3/8	12 1/8	4	11 1/8	(66) 10d	(22) 16d	10130 45.06	16400 72.95	7195 32.00	11645 51.80		



Plated Truss Connectors

See footnotes
on p. 258.

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

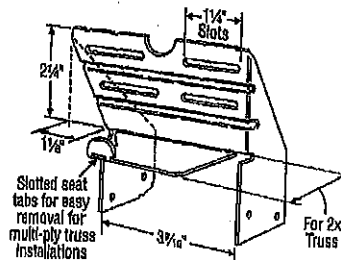


TC24
U.S. Patent 4,932,173

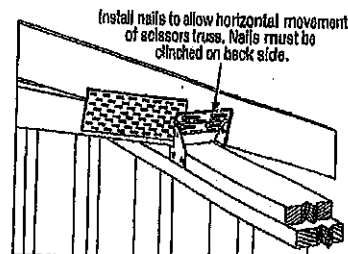


Typical TC24 Installation

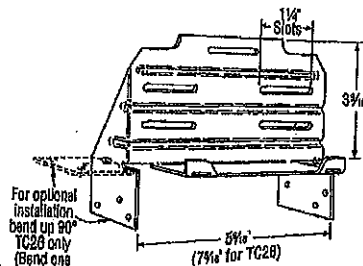

TC26
(TC28 Similar)

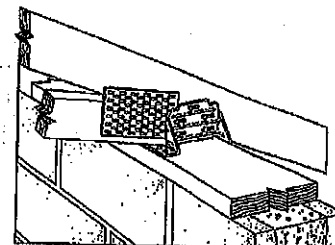

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer
(8", 10", 12" Wall Installation Similar)

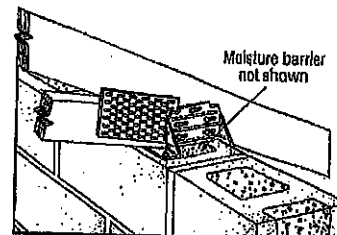

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift ($K_0=1.15$)	Uplift ($K_0=1.15$)
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift ($K_0=1.15$)	Uplift ($K_0=1.15$)
TC26	(5) 10d	(6) 10d x 1 1/2"	810	680
	(5) 10d	(6) 10d	930	680

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC26 Installation with 10d nails requires minimum 3" top plate thickness.
4. TC26 fastened to grouted concrete block with (6) - 1/2" x 2 1/4" Titen screws has a factored uplift resistance of 275 lb.



SIMPSON
STRONG-TIE

© 2007 Simpson Strong-Tie Company
All rights reserved.

PERFECT COPY

(800) 999-5099
strongtie.com

H/TSP

SIMPSON
Strong-Tie

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_0 = 1.16$)					
					D.Fir-L			S-P-F		
		To Rafters/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(6) 8d x 1½"	(4) 8d	—	740	685	300	680	485	216
					3.29	3.05	1.33	3.02	2.16	0.96
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
					3.68	0.71	0.71	3.38	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H8	18	(4) 8d	(4) 8d	—	740	180	285	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ³	18	(5) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A ⁹	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	565	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^{7,8}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1465	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.08	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
		[2] (12) 8d x 1½"	(15) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
TSP	16	(9) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
					5.76	1.96	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.98	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 695 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastener to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.182" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27–28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

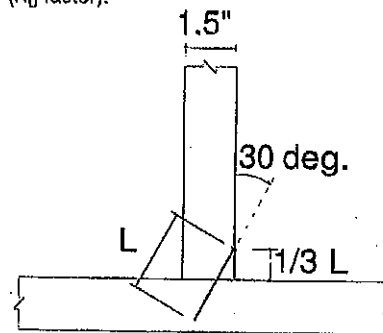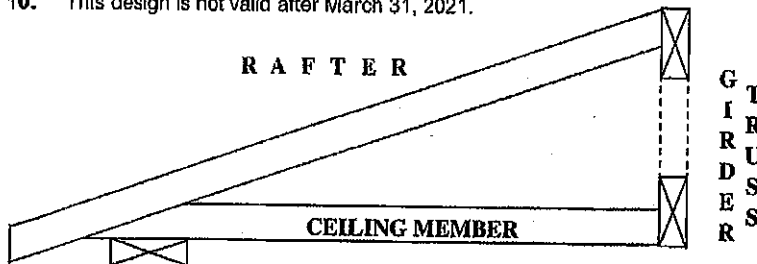


TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (In)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek®

MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	28	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37679H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

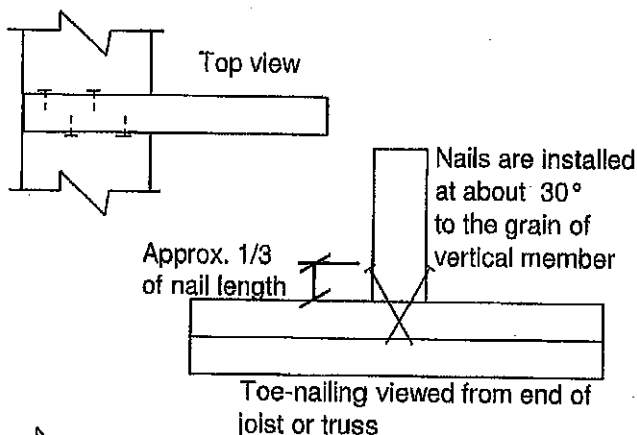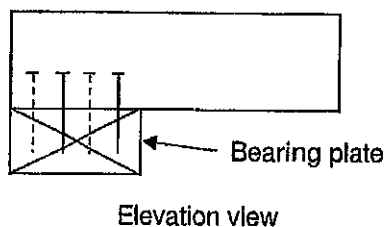

Toe-nailing on 2x4 Bearing Plate

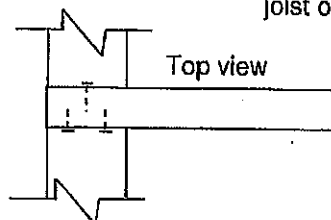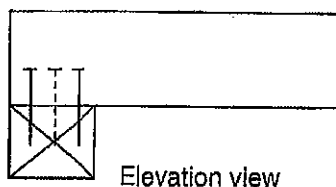

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7


PEO
Certificate No. 10889486




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/8" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

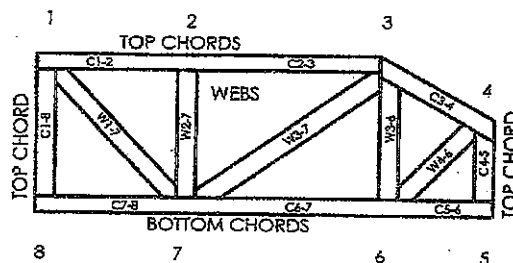

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

T1996-L 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MTE-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane of joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.


TN 15-001 Piggyback Bracing

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

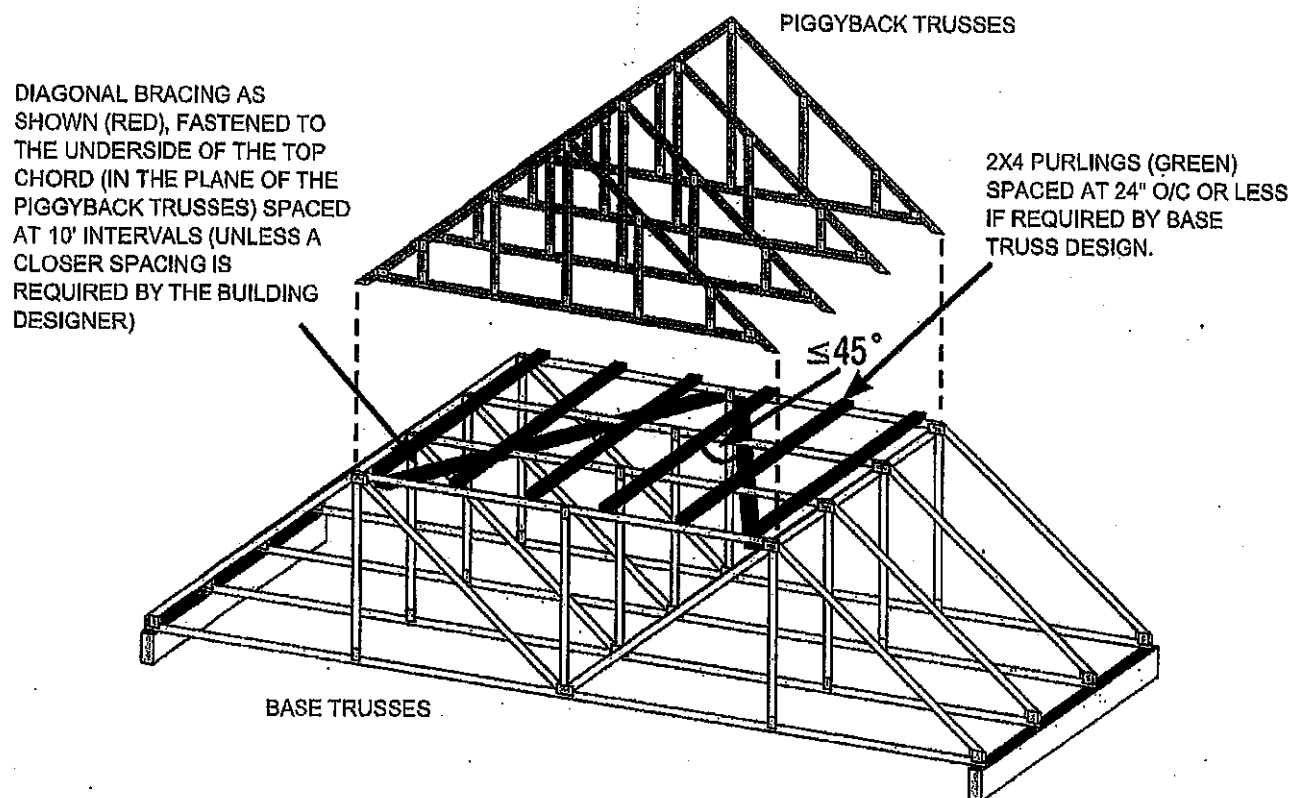

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. Is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1800213

Feb 09, 2018