


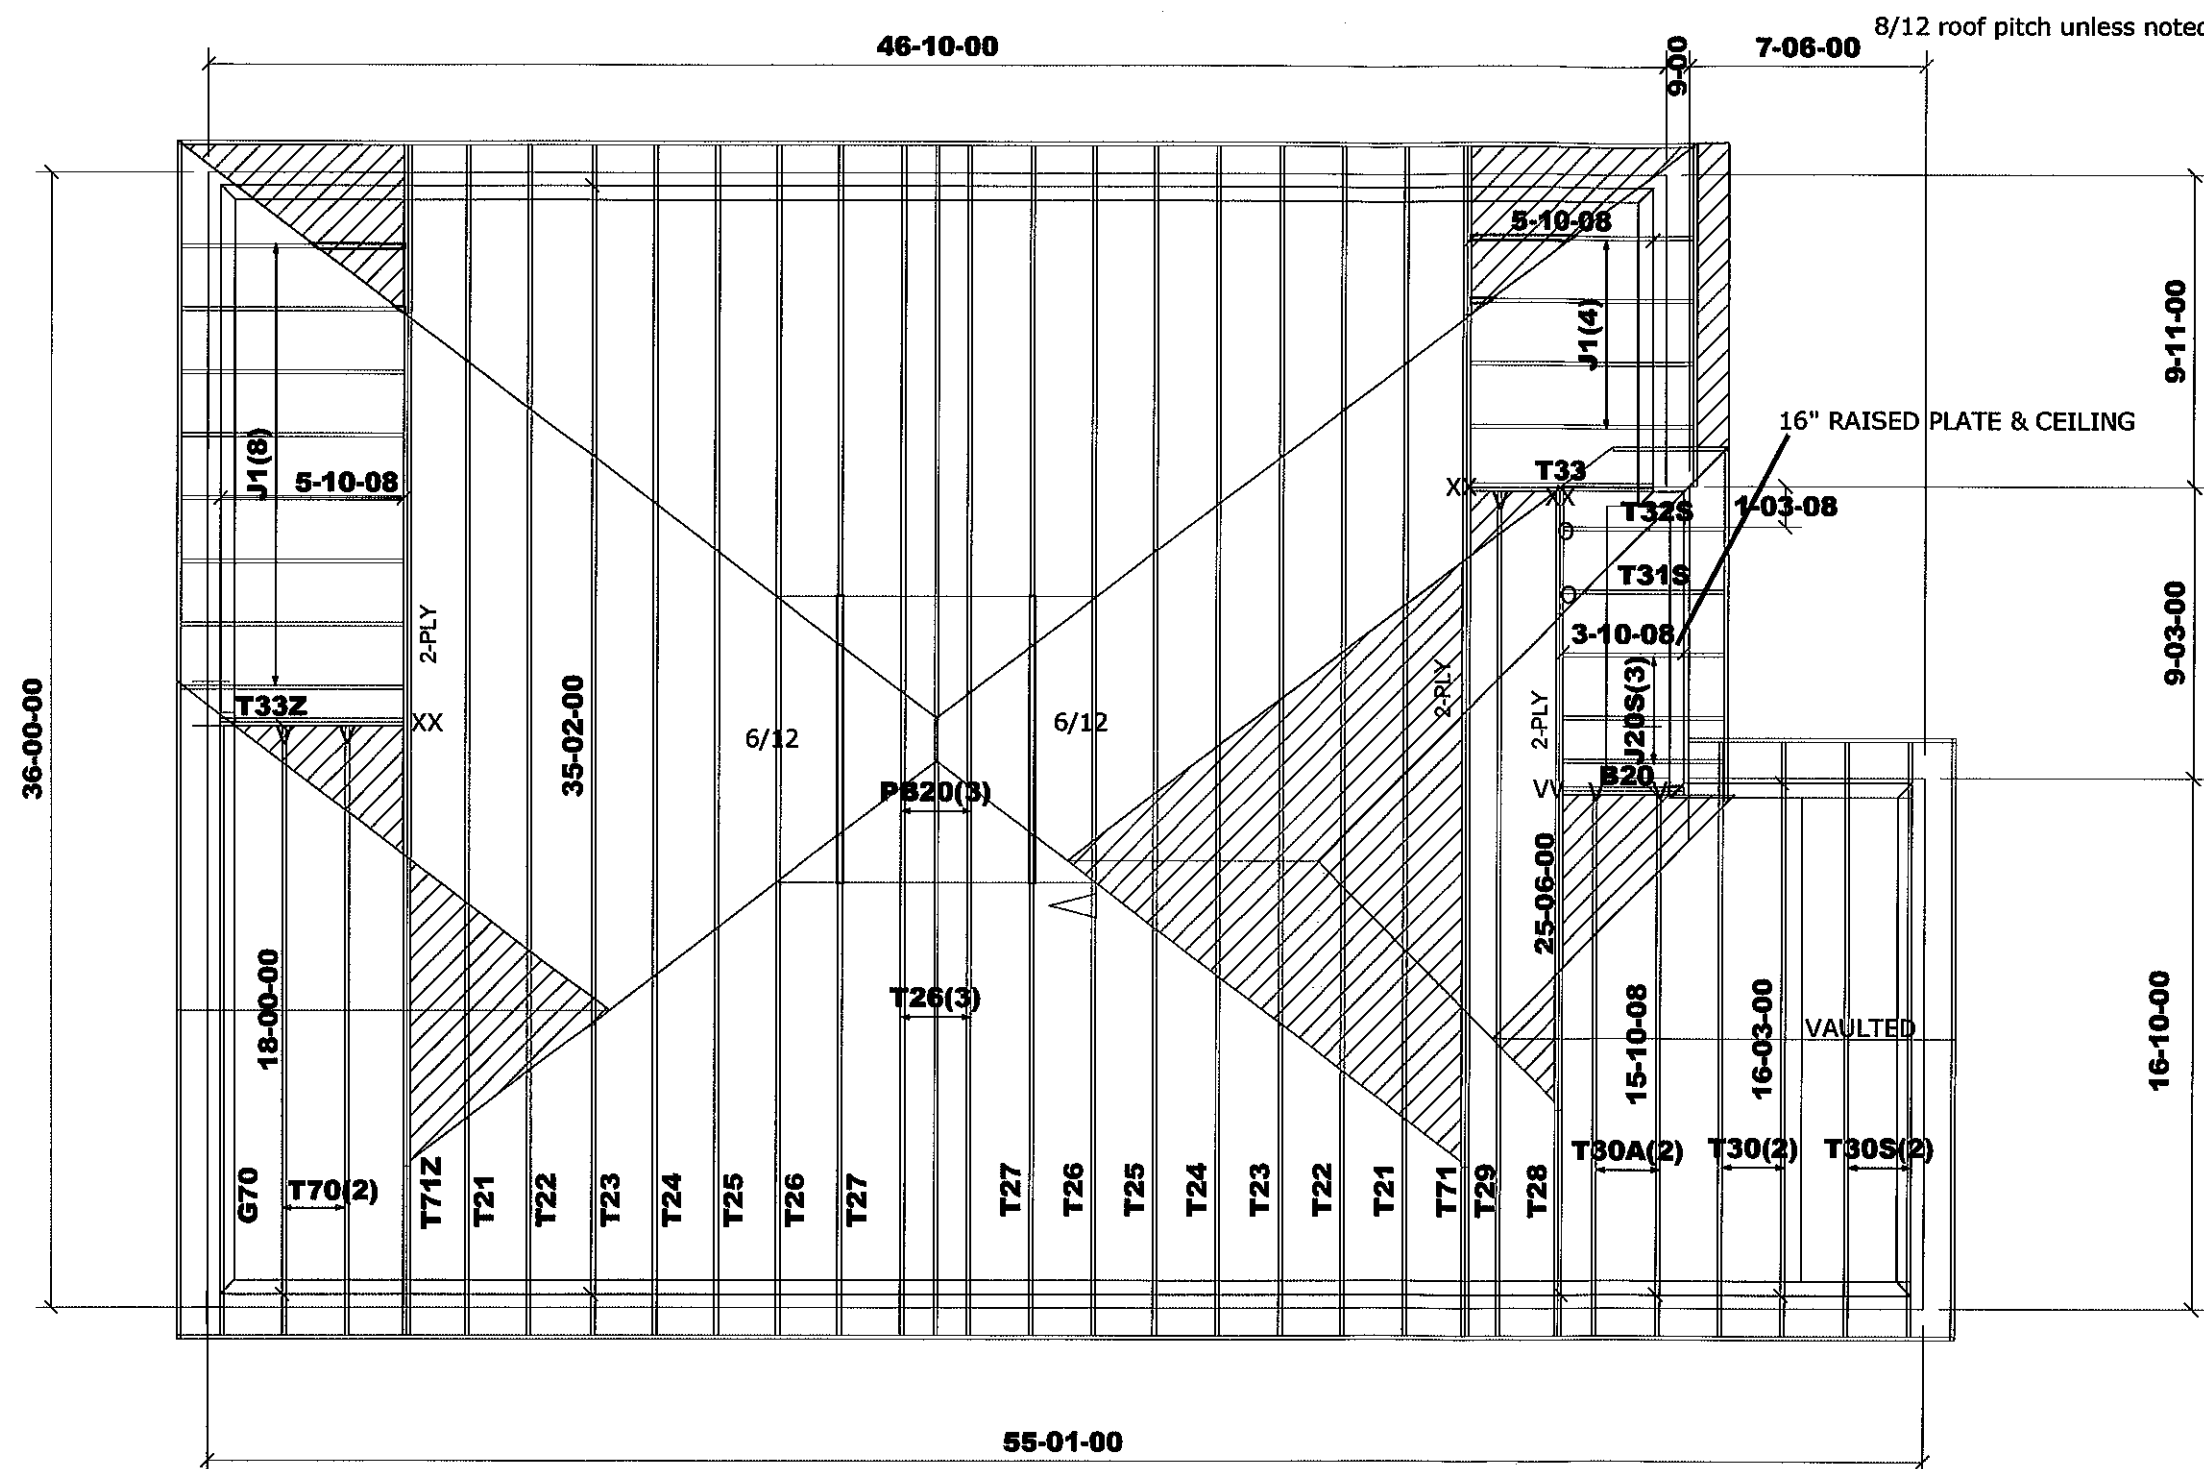

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.


DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:


TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

CITY OF HAMILTON Building Division
21-107176
THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
HARDWARE: THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)
LUS26-2-(VV)
FEB 23 2021
DATE
FOR CHIEF BUILDING OFFICIAL

BEAMS:
B20= 2 - 2x10 SPF #2

 DENOTES: CONVENTIONAL FRAMING

	Job Track: 51225	Builder / Location: GREEN PARK HOMES / WATERDOWN		Model / Elevation: MOUNTAINASH 5 - 335 / 2- STD OR OPT.5 BR	Mike ver 8.3.3.247
	Plan Log: 202406	Project: RUSSELL GARDENS PH.3		THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.	
	Layout ID: 415052	Date: 2020-12-08	Sales: Mario DiCano	Designer: JG / ND	

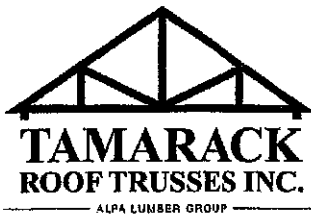

DELIVERY SHIPLIST


Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 5
 Lot #: 335
 Elevation: 2- STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202406
 Layout ID: 408169
 Ref #
 Page: 1 of 2
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T20 Hip Girder	8 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	320.72 200.67		
	1 2-ply	T20Z Hip Girder	8 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	320.72 200.67		
	2	T21 Hip	8 /12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	279.76 177.00		
	2	T22 Hip	8 /12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	302.77 191.33		
	2	T23 Hip	8 /12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	309.14 195.67		
	2	T24 Hip	8 /12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	316.79 198.67		
	2	T25 Hip	8 /12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	329.26 205.00		
	5	T26 Hip	8 /12	35-02-00	10-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	857.95 538.33		
	2	T27 Hip	8 /12	35-02-00	11-01-04	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	332.54 206.67		
	1 2-ply	T28 Hip Girder	8 /12	25-06-00	5-03-13	2 x 4 2 x 6	1-03-08	1-04-13 2-08-13	244.99 150.00		
	1	T29 Hip	8 /12	25-06-00	6-07-13	2 x 4	1-03-08	1-04-13 2-08-13	108.69 70.33		
	2	T30 Common	8 /12	16-03-00	6-09-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	144.92 91.33		
	2	T30A Common	8 /12	15-10-08	6-09-13	2 x 4	1-03-08	1-04-13 1-04-13	139.63 87.67		
	2	T30S Scissor	8 /12 4 /12	16-03-00	6-09-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	133.1 87.33		

DELIVERY SHIPLIST

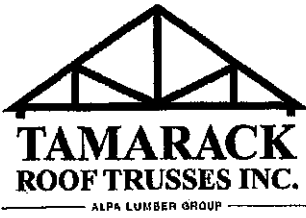

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 5
 Lot #: 335
 Elevation: 2- STD OR OPT.5 BR

Job Track: 51225
 PlanLog: 202406
 Layout ID: 408169
 Ref #
 Page: 2 of 2
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T31S Half Hip	8 /12	3-10-08	4-09-13	2 x 4	1-03-08	1-04-13 4-09-13	29.4 20.17		
	1	T32S Half Hip	8 /12	3-10-08	3-05-13	2 x 4	1-03-08	1-04-13 3-05-13	24.65 17.17		
	1 2-ply	T33 Jack-Closed Girder	6 /12	5-10-08	4-01-04	2 x 4 2 x 6		1-02-00 4-01-04	57.64 37.00		
	3	PB20 Piggyback	8 /12	9-00-12	2-00-00	2 x 4			74.54 50.50		
	21	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	352.68 224.00		
	3	J20S Jack-Open	8 /12	3-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	85.86 57.50		

TOTAL # TRUSS= 61

TOTAL BFT OF ALL TRUSSES= 3005.01 BFT.

TOTAL WEIGHT OF ALL TRSSES 4765.74 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
2	Hardware	HGUS26-2	
3	Hardware	LJS26DS	
2	Hardware	LUS24	

TOTAL NUMBER OF
ITEMS= 7

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408168	T1	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:18 2020 Page 2
ID:DMCubINVR6TstF0a31y6I zns1I-MonIQ2FIKqQuZWGH 1Yq9JSi 3IK34wGOWeSzNBFL

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	5.0	8.0	2.50 3.25
C	TTWW+m	MT20	7.0	8.0	3.75 1.50
D	TMVW-t	MT20	5.0	6.0	
E	TMVW+w	MT20	3.0	6.0	
F	TS-t	MT20	5.0	6.0	
G	TMVW-t	MT20	5.0	6.0	
H	TTWW+m	MT20	7.0	8.0	3.75 1.50
I	TMVW-t	MT20	5.0	8.0	2.60 3.25
K	BMV1+p	MT20	3.0	6.0	
L	BMVW-t	MT20	5.0	6.0	
M	BMVW-t	MT20	5.0	8.0	2.50 2.25
N	BS-t	MT20	5.0	6.0	
O	BMVW-t	MT20	5.0	8.0	
P	BS-t	MT20	5.0	6.0	
Q	BMVW-t	MT20	5.0	6.0	2.50 2.25
R	BMVW-t	MT20	5.0	6.0	
S	BMV1+p	MT20	3.0	6.0	

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
M-AS	0 / 2586	-18.5	-18.5 0.12 (1)	10.00			
AS-AT	0 / 2586	-18.5	-18.5 0.12 (1)	10.00			
AT-AU	0 / 2586	-18.5	-18.5 0.12 (1)	10.00			
AU-L	0 / 2586	-18.5	-18.5 0.12 (1)	10.00			
L-AV	0 / 0	-18.5	-18.5 0.05 (1)	10.00			
AV-K	0 / 0	-18.5	-18.5 0.05 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-11-8	-38	-42	---	FRONT	VERT	DEAD	---	C1
C	2-11-8	-191	-191	---	FRONT	VERT	SNOW	---	C1
H	32-2-8	-38	-42	---	FRONT	VERT	DEAD	---	C1
H	32-2-8	-116	-116	---	FRONT	VERT	TOTAL	---	C1
H	32-2-8	-191	-191	---	FRONT	VERT	SNOW	---	C1
L	31-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
P	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	3-11-4	-111	-111	---	FRONT	VERT	TOTAL	---	C1
U	5-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	17-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	19-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	21-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	23-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AE	25-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AF	27-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AG	29-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AH	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AL	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AM	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AN	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	17-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AP	19-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AQ	21-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AR	23-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AS	25-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AT	27-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AU	29-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AV	33-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007129

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408168	T1Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 9 Oct 2019 Mitek Industries, Inc. Sat Apr 25 12:34:49 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns1f-qoL41NGw50yHWjVSripnNnrbzOizT47D9w8UBuzNBRK

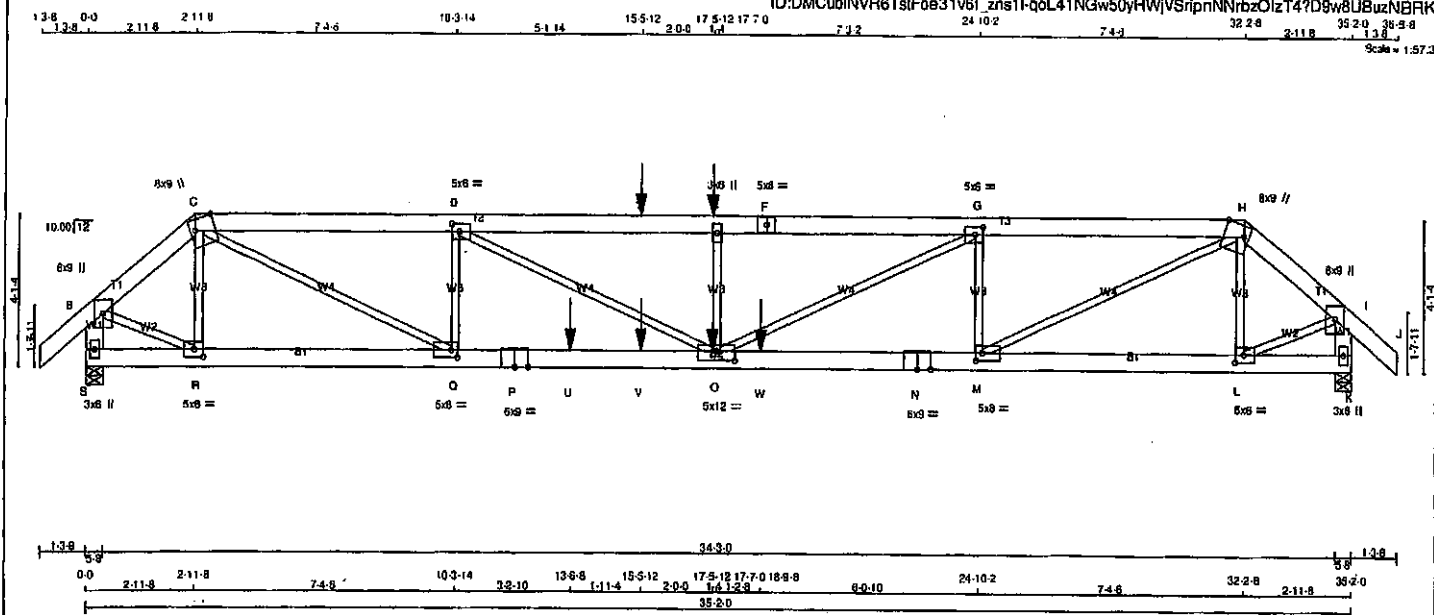

TOTAL WEIGHT = 2 X 183 = 365 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x6 DRY	No.2	SPF
C - F	2x6 DRY	No.2	SPF
F - H	2x6 DRY	No.2	SPF
H - J	2x6 DRY	No.2	SPF
S - B	2x6 DRY	No.2	SPF
K - I	2x6 DRY	No.2	SPF
S - P	2x6 DRY	2100F 1.8E	SPF
P - N	2x6 DRY	2100F 1.8E	SPF
N - K	2x6 DRY	2100F 1.8E	SPF

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY, SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122'X3') SPIRAL NAILS		
A - C	2 12	TOP
C - F	2 12	SIDE(183.1)
F - H	2 12	TOP
H - J	2 12	TOP
S - B	2 12	TOP
K - I	2 12	TOP
BOTTOM CHORDS : (0.122'X3') SPIRAL NAILS		
S - P	2 12	TOP
P - N	2 12	SIDE(197.8)
N - K	2 12	TOP
WEBS : (0.122'X3') SPIRAL NAILS	2x3 1 6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	UP	BRG	BRG	IN-SX	IN-SX
S	3983	0	3983	0	0	5-8	5-8		
K	3687	0	3687	0	0	5-8	5-8		

UNFACTORED REACTIONS							
1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	2793	1890 / 0	0 / 0	0 / 0	0 / 0	902 / 0	0 / 0
K	2599	1758 / 0	0 / 0	0 / 0	0 / 0	843 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 42	-91.8	-91.8 0.04 (1)	10.00	R-C	-1088 / 0	0.13 (1)
B-C	-3983 / 0	-91.8	-91.8 0.08 (1)	5.65	C-Q	0 / 7263	0.90 (1)
C-D	-8534 / 0	-91.8	-91.8 0.37 (1)	3.74	Q-D	-2169 / 0	0.26 (1)
D-E	-12331 / 0	-91.8	-91.8 0.52 (1)	3.20	D-O	0 / 3130	0.39 (1)
E-F	-12331 / 0	-91.8	-91.8 0.52 (1)	3.20	O-E	-776 / 0	0.09 (1)
F-G	-12331 / 0	-91.8	-91.8 0.50 (1)	3.23	G-Q	0 / 4203	0.52 (1)
G-H	-8575 / 0	-91.8	-91.8 0.33 (1)	3.94	M-H	0 / 9383	0.31 (1)
H-I	-3759 / 0	-91.8	-91.8 0.08 (1)	5.78	L-H	-843 / 0	0.10 (1)
I-J	0 / 42	-91.8	-91.8 0.04 (1)	10.00	B-R	0 / 3239	0.40 (1)
S-B	-3945 / 0	0.0	0.0 0.14 (1)	7.14	L-I	0 / 3052	0.38 (1)
K-I	-3733 / 0	0.0	0.0 0.13 (1)	7.29			
S-R	0 / 0	-18.5	-18.5 0.02 (4)	10.00			
R-Q	0 / 3013	-18.5	-18.5 0.21 (1)	10.00			
Q-P	0 / 8534	-18.5	-18.5 0.67 (1)	10.00			
P-U	0 / 9534	-18.5	-18.5 0.67 (1)	10.00			
U-V	0 / 9534	-18.5	-18.5 0.67 (1)	10.00			
V-O	0 / 9534	-18.5	-18.5 0.67 (1)	10.00			
O-W	0 / 8575	-18.5	-18.5 0.49 (1)	10.00			
W-N	0 / 8575	-18.5	-18.5 0.49 (1)	10.00			
N-M	0 / 8575	-18.5	-18.5 0.49 (1)	10.00			
M-L	0 / 2844	-18.5	-18.5 0.12 (1)	10.00			
L-K	0 / 0	-18.5	-18.5 0.05 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)														
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.					
E	17-5-12	-110	-110	---	BACK	VERT	TOTAL	---	C1					
O	17-5-12	-28	-28	---	BACK	VERT	TOTAL	---	C1					
T	15-5-12	-110	-110	---	BACK	VERT	TOTAL	---	C1					
U	13-8-8	-1615	-1615	---	BACK	VERT	TOTAL	---	C1					
V	15-5-12	-28	-28	---	BACK	VERT	TOTAL	---	C1					
W	18-9-8	-1620	-1620	---	BACK	VERT	TOTAL	---	C1					

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/898 (0.35')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/657 (0.84')

CSI: TC=0.52/1.00 (D-E:1), BC=0.67/1.00 (O-Q:1),
WB=0.90/1.00 (G-Q:1), SB=0.53/1.00 (M-O:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (C) (INPUT = 0.90)
JSI METAL = 0.95 (P) (INPUT = 1.00)

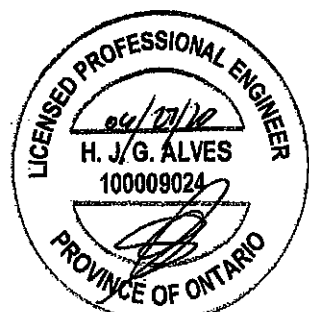

Structural component only
DWG# T-2007130 1/2

CONTINUED ON PAGE 2


JOB NAME 408168	TRUSS NAME T1Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:49 2020 Page 2
ID:DMCubiNVR6TsIFos31v6I zns1l-qoL41NGw50yHWiVSripnNNrbzOizT4?D9w8UBuzNBRK

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	6.0	9.0		
C	TTWW+m	MT20	8.0	9.0	Edge	6.50
D	TMWW-l	MT20	5.0	6.0	2.50	2.50
E	TMW+w	MT20	3.0	6.0		
F	TS-l	MT20	5.0	6.0		
G	TMWW-l	MT20	5.0	6.0	2.50	2.50
H	TTWW+m	MT20	8.0	9.0	Edge	6.50
I	TMVW+p	MT20	6.0	9.0		
K	BMV1+p	MT20	3.0	6.0		
L	BMWW-l	MT20	5.0	6.0	2.50	2.75
M	BMWW-l	MT20	5.0	6.0	2.50	2.00
N	BS-l	MT20	6.0	9.0		
O	BMWWW-l	MT20	5.0	12.0	3.00	6.00
P	BS-l	MT20	6.0	9.0		
Q	BMWW-l	MT20	5.0	6.0	2.50	2.00
R	BMWW-l	MT20	5.0	6.0	2.50	2.75
S	BMV1+p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

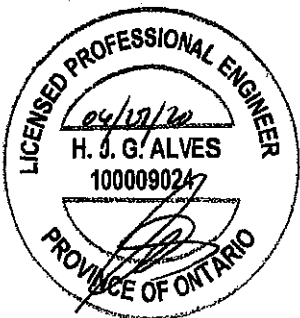

Structural component only
DWG# T-2007130 42

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T2	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:50 2020 Page 1
ID:DMCubINVR6TstFoe31v6L_zns11-17vSFH2sJ487s3/PPK0vaOkaof0CfaM0at1jKzNBfJ
Scale = 1:57.3

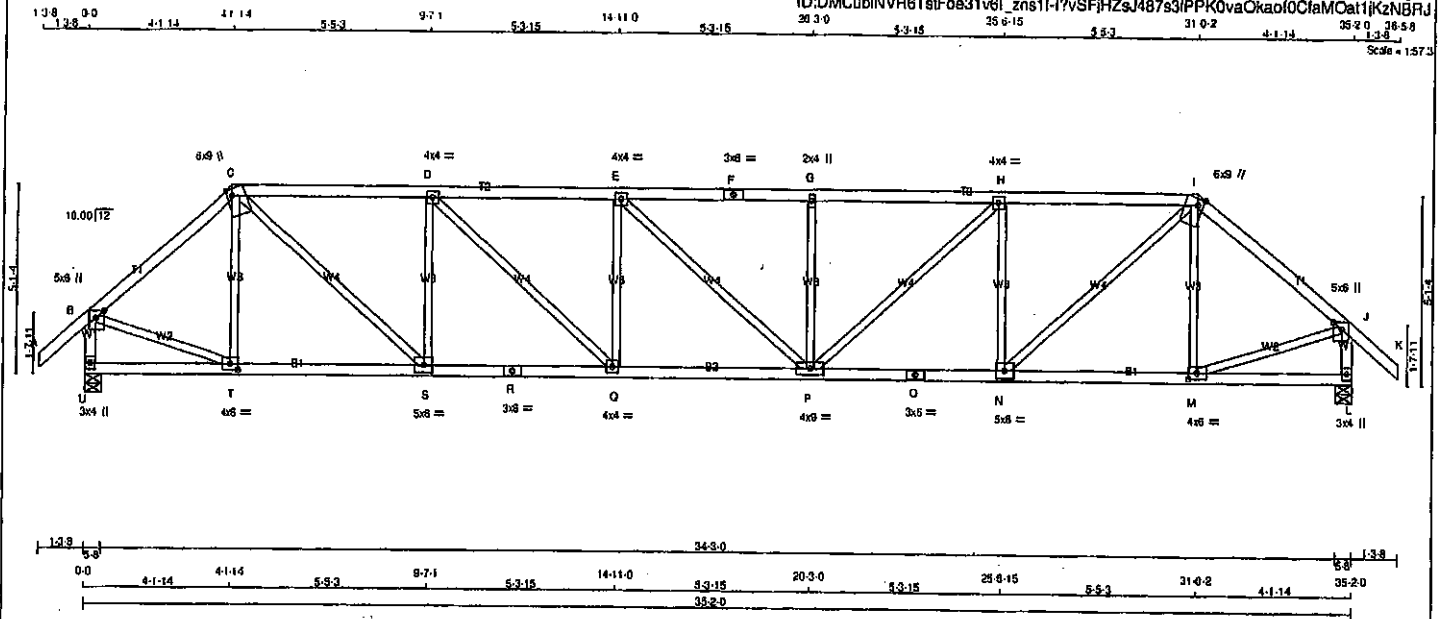

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - K	2x4	DRY	No.2
L - B	2x4	DRY	No.2
L - D	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (Table in inches)			
JT	TYPE	PLATES	W LEN Y X
B	TMW+P	MT20	5.0 6.0 Edge 2.75
C	TTWW+m	MT20	6.0 9.0 Edge 1.75
D, E, H			
D	TMW+L	MT20	4.0 4.0
F	TS-1	MT20	3.0 8.0
G	TMW+P	MT20	2.0 4.0
I	TTWW+m	MT20	6.0 9.0 Edge 1.75
J	TMW+P	MT20	5.0 6.0 Edge 2.75
L	BMV+P	MT20	3.0 4.0
M	BMW+L	MT20	4.0 6.0 2.00 2.75
N	BMW+L	MT20	5.0 6.0
O	BS-1	MT20	3.0 8.0
P	BMW+P	MT20	4.0 9.0
Q	BMW+L	MT20	4.0 4.0
R	BS-1	MT20	3.0 6.0
S	BMW+L	MT20	5.0 6.0
T	BMW+L	MT20	4.0 6.0 2.00 2.75
U	BMV+P	MT20	3.0 4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS	REACT	DOWN	HORIZ	BRG	IN-SX	BRG	IN-SX
U	2088	0	2088	0	0	5-8	5-8	5-8	5-8
L	2088	0	2088	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST LOASE		MAX/MIN. COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	COMBINED	SNOW	LIVE	PERM.LIVE
U	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	1458	971 / 0	0 / 0	0 / 0
L	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	1458	971 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE	FACTORED	MAX.	MEMB.	FORCE	FACTORED	MAX.
FR-TO	(LBS)	VERT. LOAD (PLF)	CS1 (LC)	UNBRAC LENGTH	(LBS)	CS1 (LC)	
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	T-C	-358 / 0	0.14 (1)
B-C	-1960 / 0	-91.8	-91.8 0.38 (1)	4.48	C-S	0 / 1836	0.41 (1)
C-D	-2871 / 0	-91.8	-91.8 0.57 (1)	3.69	S-D	-1118 / 0	0.43 (1)
D-E	-3508 / 0	-91.8	-91.8 0.55 (1)	3.21	D-Q	0 / 858	0.19 (1)
E-F	-3505 / 0	-91.8	-91.8 0.53 (1)	3.36	Q-E	-475 / 0	0.18 (1)
F-G	-3505 / 0	-91.8	-91.8 0.53 (1)	3.36	E-P	-2 / 0	0.00 (1)
G-H	-3505 / 0	-91.8	-91.8 0.56 (1)	3.20	P-Q	-474 / 0	0.18 (1)
H-I	-2871 / 0	-91.8	-91.8 0.57 (1)	3.59	P-H	0 / 853	0.19 (1)
I-J	-1980 / 0	-91.8	-91.8 0.38 (1)	4.48	N-I	-1117 / 0	0.43 (1)
J-K	0 / 41	-91.8	-91.8 0.13 (1)	10.00	N-I	0 / 1837	0.41 (1)
U-B	-2037 / 0	0.0	0.0 0.22 (1)	5.92	M-I	-358 / 0	0.14 (1)
L-J	-2037 / 0	0.0	0.0 0.22 (1)	5.92	B-T	0 / 1571	0.35 (1)
U-T	0 / 0	-18.5	-18.5 0.10 (4)	10.00	M-J	0 / 1571	0.35 (1)
T-S	0 / 1494	-18.5	-18.5 0.30 (1)	10.00			
S-R	0 / 2871	-18.5	-18.5 0.51 (1)	10.00			
R-Q	0 / 2871	-18.5	-18.5 0.51 (1)	10.00			
Q-P	0 / 3508	-18.5	-18.5 0.62 (1)	10.00			
P-O	0 / 2872	-18.5	-18.5 0.51 (1)	10.00			
O-N	0 / 2872	-18.5	-18.5 0.51 (1)	10.00			
N-M	0 / 1494	-18.5	-18.5 0.30 (1)	10.00			
M-L	0 / 0	-18.5	-18.5 0.10 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2010
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.20")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CSI: TC=0.88/1.00 (G-H:1), BC=0.62/1.00 (P-Q:1), WB=0.43/1.00 (D-S:1), SS=0.23/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (N) (INPUT = 0.90)
JSI METAL = 0.90 (C) (INPUT = 1.00)

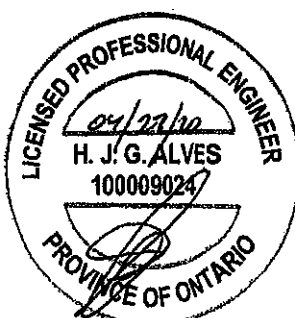

Structural component only
DWG# T-2007131

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T3	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		Version 8.310 8 Oct 2019 Mitek Industries, Inc. Sat Apr 25 12:34:51 2020 Page 1			

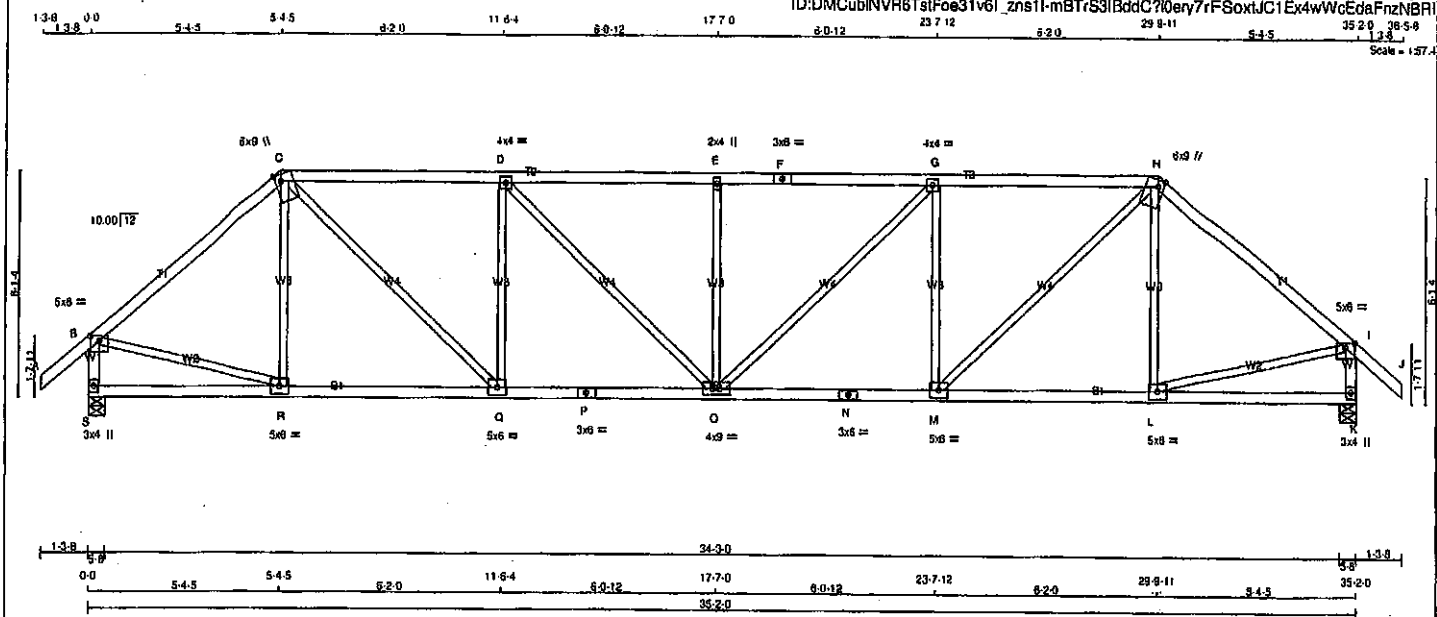

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
S - B	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
S - P	2x4	DRY	No.2	SPF	
P - N	2x4	DRY	No.2	SPF	
N - K	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.50	3.00
C	TTWW-m	MT20	6.0	9.0	Edge	1.75
D	TMVW-t	MT20	4.0	4.0		
E	TMVW-w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMVW-t	MT20	4.0	4.0		
H	TTWW-m	MT20	6.0	9.0	Edge	1.75
I	TMVW-p	MT20	5.0	6.0	1.50	3.00
K	BMV1-p	MT20	3.0	4.0		
L, M, Q, R						
L	BMVW-t	MT20	5.0	6.0		
N	BS-t	MT20	3.0	6.0		
O	BMVW-t	MT20	4.0	9.0		
P	BS-t	MT20	3.0	6.0		
S	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORZ	UPLIFT
S	2066	0	0	5-8
K	2066	0	0	5-8

UNFACTORED REACTIONS	1ST LCASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	SNOW
S	1458	971/0
K	1458	971/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 3.28 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	W E B S	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0/41	-91.8 -91.8 0.13 (1)	R-C	-248/7
B-C	-2004/0	-91.8 -91.8 0.54 (1)	C-Q	0/1538
C-D	-2653/0	-91.8 -91.8 0.74 (1)	Q-D	-943/0
D-E	-2978/0	-91.8 -91.8 0.78 (1)	D-O	0/450
E-F	-2978/0	-91.8 -91.8 0.78 (1)	O-E	-513/0
F-G	-2978/0	-91.8 -91.8 0.78 (1)	G-O	0/450
G-H	-2653/0	-91.8 -91.8 0.74 (1)	M-G	-943/0
H-I	-2004/0	-91.8 -91.8 0.64 (1)	M-H	0/1538
I-J	0/41	-91.8 -91.8 0.13 (1)	L-H	-248/7
S-B	-2026/0	0.0 0.0 0.22 (1)	B-R	0/1580
K-I	-2026/0	0.0 0.0 0.22 (1)	L-I	0/1580
S-R	0/0	-18.5 -18.5 0.14 (4)		
R-Q	0/1532	-18.5 -18.5 0.33 (1)		
Q-P	0/2653	-18.5 -18.5 0.49 (1)		
P-O	0/2653	-18.5 -18.5 0.49 (1)		
O-N	0/2653	-18.5 -18.5 0.49 (1)		
N-M	0/2653	-18.5 -18.5 0.49 (1)		
M-L	0/1532	-18.5 -18.5 0.33 (1)		
L-K	0/0	-18.5 -18.5 0.14 (4)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 0.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/869 (0.18")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/869 (0.29")

CSI: TC=0.78/1.00 (E-G:1), BC=0.49/1.00 (M-O:1), WB=0.55/1.00 (G-M:1), SS=0.27/1.00 (C-D:1)

COL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (B) (INPUT = 0.90)
JSI METAL = 0.85 (N) (INPUT = 1.00)





Structural component only
DWG# T-2007132

JOB NAME 408168	TRUSS NAME T4	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DWG NO.
---------------------------	-------------------------	----------------------	-----------------	--------------------------------------	-------------	---------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 12:34:52 2020 Page 1

ID:DMCubINVR6TsIFoe31v6I zns1I-EN1DIPipOxKsNAD1WqNU_?T6RbNZqQVfrM8oDzN8RH

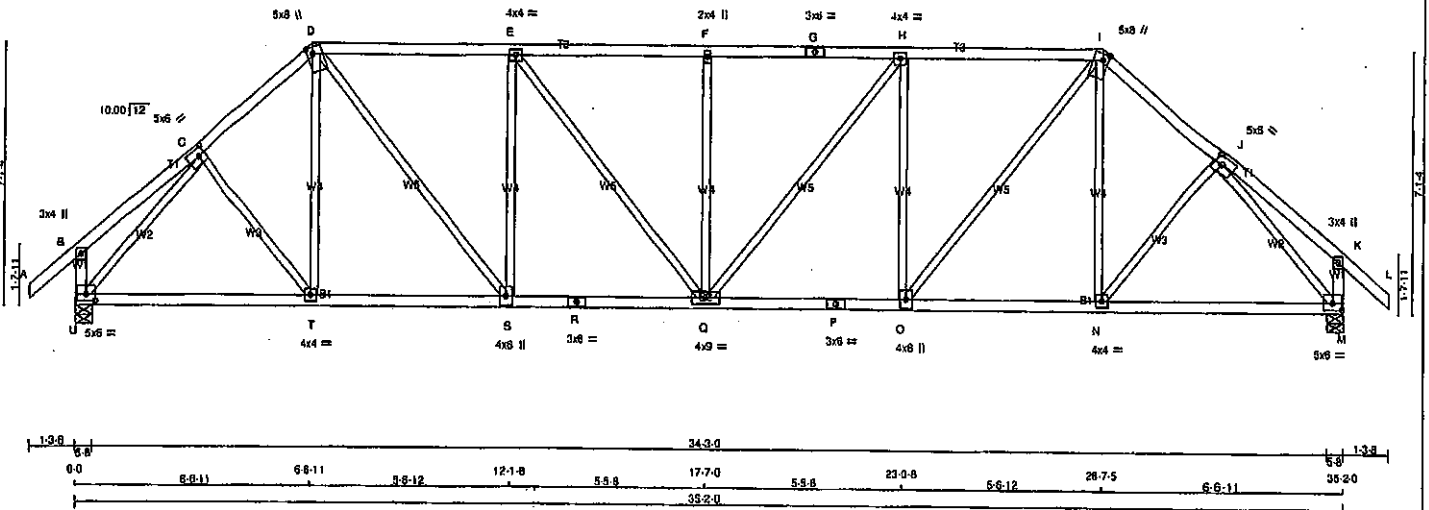

TOTAL WEIGHT = 2 X 162 = 323 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - K	2x4	DRY	No.2
K - R	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
	FACTORED	MAXIMUM FACTORED	INPUT	REQD			
	GROSS REACTION	GROSS REACTION	BRG	BRG			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
U	2068	0	2068	0	0	5-8	5-8
M	2068	0	2068	0	0	5-8	5-8
UNFACTORED REACTIONS							
	1ST LCASE	MAX/MIN	COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
U	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
M	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M							
BRACING							
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.							
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.							
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.							

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 8, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, NBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/899 (0.13")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.23")

CSI: TC=0.57/1.00 (E-F:1), BC=0.42/1.00 (O-Q:1), WB=0.98/1.00 (J-M:1), SSI=0.24/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.89 (I) (INPUT = 0.90)
JSI METAL= 0.72 (P) (INPUT = 1.00)

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMVW+1	MT20	5.0	8.0	2.50 2.25
D	TTWV+m	MT20	5.0	8.0	2.00 1.75
E	TMVW+1	MT20	4.0	4.0	
F	TMVW+w	MT20	2.0	4.0	
G	TS-1	MT20	3.0	6.0	
H	TMVW+1	MT20	4.0	4.0	
I	TTWV+m	MT20	5.0	8.0	2.00 1.75
J	TMVW+1	MT20	6.0	6.0	2.50 2.25
K	TMV+p	MT20	3.0	4.0	
M	BMVW+1	MT20	5.0	6.0	2.25 3.00
N	BMVW+1	MT20	4.0	4.0	
O	BMVW+1	MT20	4.0	8.0	
P	BS-1	MT20	3.0	4.0	
Q	BMVWV+1	MT20	4.0	9.0	
R	BS-1	MT20	3.0	6.0	
S	BMVW+1	MT20	4.0	6.0	
T	BMVW+1	MT20	4.0	4.0	
U	BMVW+1	MT20	5.0	6.0	2.25 3.00

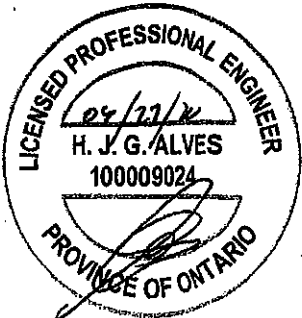

Structural component only
DWG# T-2007133

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T5	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

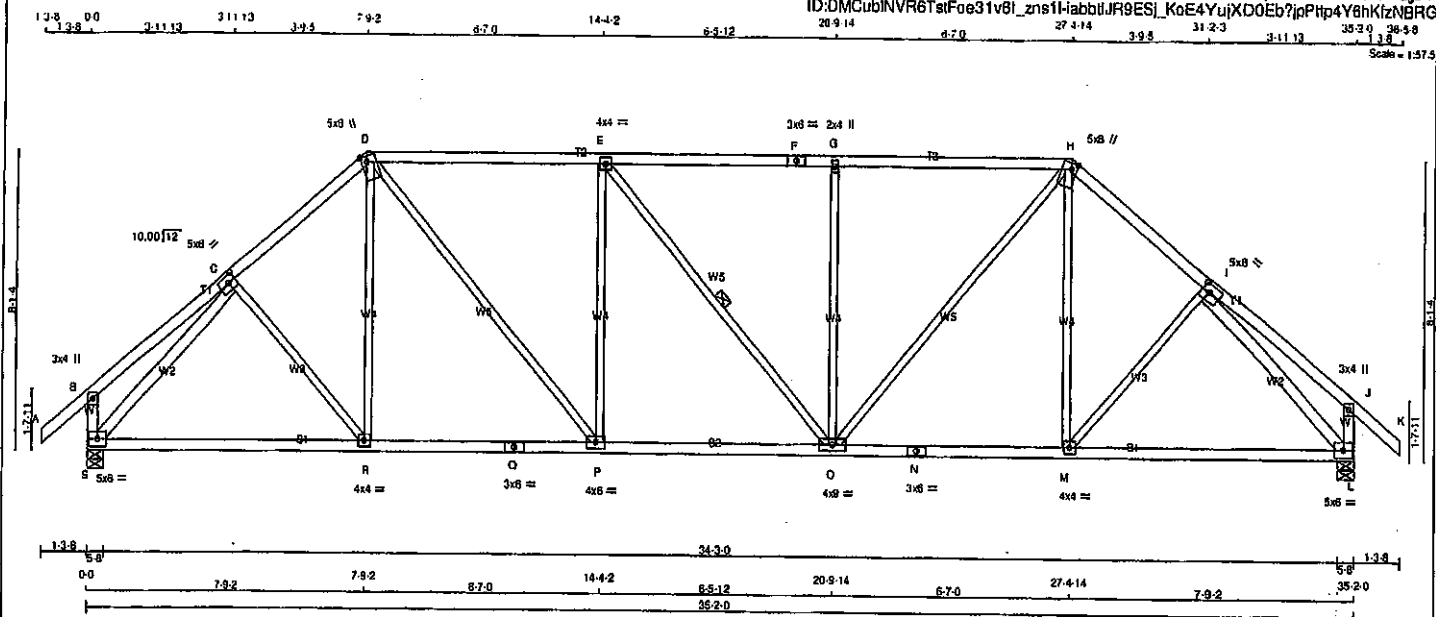

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR.
A - D	2x4	DRY	No.2		SPF
D - F	2x4	DRY	No.2		SPF
F - H	2x4	DRY	No.2		SPF
H - K	2x4	DRY	No.2		SPF
S - B	2x4	DRY	No.2		SPF
L - J	2x4	DRY	No.2		SPF
S - Q	2x4	DRY	No.2		SPF
Q - N	2x4	DRY	No.2		SPF
N - L	2x4	DRY	No.2		SPF
ALL WEBS		2x3	DRY	No.2	SPF
EXCEPT					
S - C	2x4	DRY	No.2		SPF
I - L	2x4	DRY	No.2		SPF
DRY: SEASONED LUMBER.					

PLATES (tablets in inches)	W	LEN	Y	X
JT TYPE PLATES				
B TMW-p	MT20	3.0	4.0	
C TMWW-1	MT20	5.0	6.0	2.50 2.50
D TTWW+m	MT20	5.0	6.0	2.00 1.75
E TMWW-1	MT20	4.0	4.0	
F TS-1	MT20	3.0	6.0	
G TMW-w	MT20	2.0	4.0	
H TTWW+m	MT20	5.0	6.0	2.00 1.75
I TMWW-1	MT20	5.0	6.0	2.50 2.50
J TMW-p	MT20	3.0	4.0	
L BMWW-1	MT20	5.0	6.0	
M BMWW-1	MT20	4.0	4.0	
N BS-1	MT20	3.0	6.0	
O BMWW-1	MT20	4.0	6.0	
P BMWW-1	MT20	4.0	6.0	
Q BS-1	MT20	3.0	6.0	
R BMWW-1	MT20	4.0	4.0	
S BMWW-1	MT20	5.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
	FACTORED	MAXIMUM FACTORED	INPUT	RECORD			
	GROSS REACTION	GROSS REACTION	BRG	BRG			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
S	2068	0	2068	0	0	5-8	5-8
L	2068	0	2068	0	0	5-8	5-8
UNFACTORED REACTIONS							
1ST LCASE	MAX/MIN	COMPONENT	REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1458	971/0	0/0	0/0	0/0	488/0	0/0
L	1458	971/0	0/0	0/0	0/0	488/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.81 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/41	-91.8	-91.8 0.13 (1)	10.00	C-R	0/84	0.02 (4)
B-C	0/28	-91.8	-91.8 0.21 (1)	10.00	R-D	0/126	0.04 (4)
C-D	-2068/0	-91.8	-91.8 0.29 (1)	4.50	D-P	0/998	0.22 (1)
D-E	-2163/0	-91.8	-91.8 0.73 (1)	3.81	P-E	-850/0	0.82 (1)
E-F	-2162/0	-91.8	-91.8 0.73 (1)	3.81	E-O	-2/0	0.00 (1)
F-G	-2162/0	-91.8	-91.8 0.73 (1)	3.81	O-G	-649/0	0.82 (1)
G-H	-2162/0	-91.8	-91.8 0.73 (1)	3.81	O-H	0/998	0.22 (1)
H-I	-2068/0	-91.8	-91.8 0.29 (1)	4.50	M-H	0/126	0.04 (4)
I-J	0/28	-91.8	-91.8 0.21 (1)	10.00	M-I	0/84	0.02 (4)
J-K	0/41	-91.8	-91.8 0.13 (1)	10.00	S-C	-2291/0	0.97 (1)
S-B	-264/0	0.0	0.0 0.03 (1)	7.81	I-L	-2291/0	0.97 (1)
L-J	-264/0	0.0	0.0 0.03 (1)	7.81			
S-R	0/1487	-18.5	-18.5 0.38 (1)	10.00			
R-Q	0/1519	-18.5	-18.5 0.39 (1)	10.00			
Q-P	0/1519	-18.5	-18.5 0.39 (1)	10.00			
P-O	0/2163	-18.5	-18.5 0.42 (1)	10.00			
O-N	0/1519	-18.5	-18.5 0.39 (1)	10.00			
N-M	0/1519	-18.5	-18.5 0.39 (1)	10.00			
M-L	0/1487	-18.5	-18.5 0.38 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = U/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = U/999 (0.21")

CS: TC=0.73/1.00 (D-E:1), BC=0.42/1.00 (O-P:1), WB=0.97/1.00 (L:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.87 (I) (INPUT = 0.90)
JSI METAL= 0.50 (I) (INPUT = 1.00)

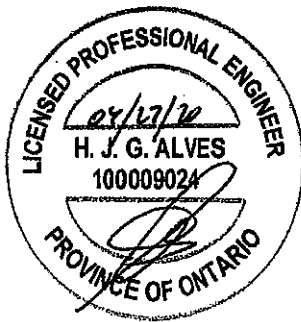

Structural component only
DWG# T-2007134

JOB NAME 408168	TRUSS NAME T6	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TAMARACK ROOF TRUSS, BURLINGTON				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:55 2020 Page 1
ID:DMCubINVR6TstFoe31v6L_zns11-eylLRLhhsIQEeycBzwBce5fFpQxtr5XsboOYzNBRE
Scale = 1/2" = 1'-0"

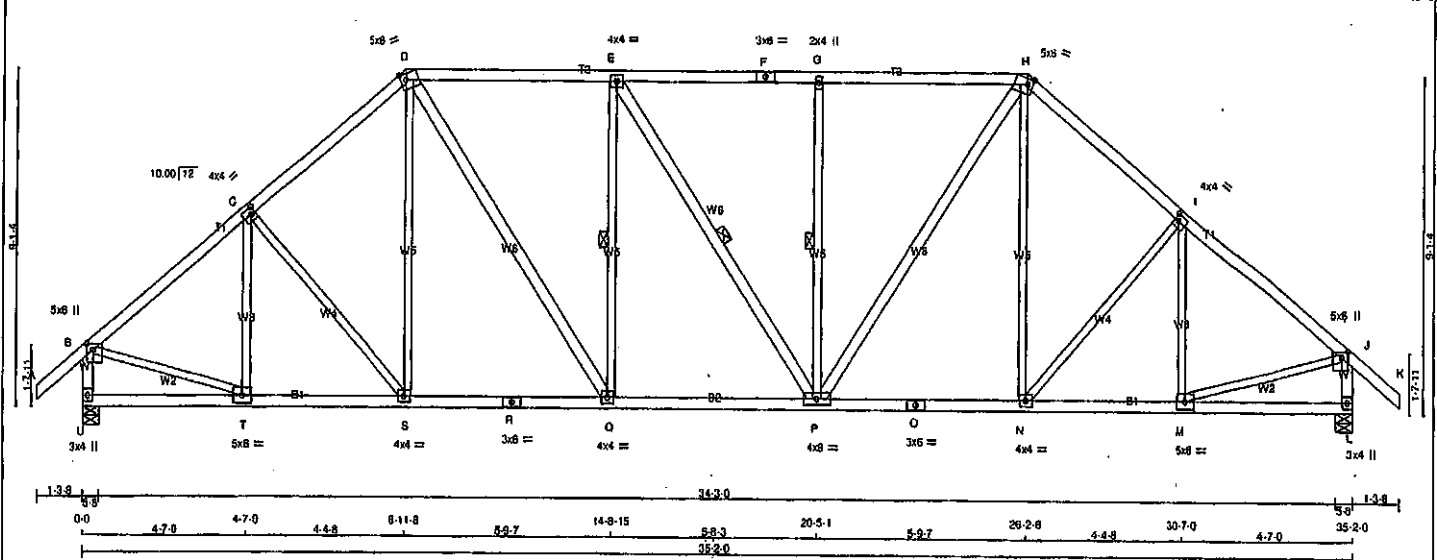

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
U - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - Q	2x4	DRY	No.2
E - P	2x4	DRY	No.2
P - H	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMVW+P	MT20	5.0	8.0	2.00 2.00
C TMVW+I	MT20	4.0	4.0	2.00 1.25
D TMVW+M	MT20	5.0	8.0	2.00 1.75
E TMVW+I	MT20	4.0	4.0	
F TS-I	MT20	3.0	6.0	
G TMVW+M	MT20	2.0	4.0	
H TMVW+M	MT20	5.0	8.0	2.00 1.75
I TMVW+I	MT20	4.0	4.0	2.00 1.25
J TMVW+P	MT20	5.0	8.0	2.00 2.00
L BMV+P	MT20	3.0	4.0	
M BMVW+I	MT20	5.0	8.0	
N, Q, S				
N BMVW+I	MT20	4.0	4.0	
O BS-I	MT20	3.0	6.0	
P BMVW+I	MT20	4.0	4.0	
R BS-I	MT20	3.0	6.0	
T BMVW+I	MT20	5.0	8.0	
U BMV+P	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
U	2088	0	0	2088	0	0	5.8	5.8	5.8
L	2088	0	0	2088	0	0	5.8	5.8	5.8

UNFACTORED REACTIONS		1ST LCASE		MAX./MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
U	1458	971/0	0/0	0/0	488/0
L	1458	971/0	0/0	0/0	488/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.44 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, E-P, Q-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	FR-TO	TO	FR-TO	TO	MEMB.	FORCE (LBS)	FR-TO	TO	MEMB.	FORCE (LBS)
A-B	0/41	-91.8	-91.8	0.13 (1)	10.00	T-C	-357/0	0.18 (1)			
B-C	-1894/0	-91.8	-91.8	0.30 (1)	4.53	Q-S	-121/0	0.10 (1)			
C-D	-1957/0	-91.8	-91.8	0.29 (1)	4.57	S-D	0/188	0.05 (4)			
D-E	-1923/0	-91.8	-91.8	0.40 (1)	4.44	D-Q	0/810	0.13 (1)			
E-F	-1821/0	-91.8	-91.8	0.37 (1)	4.49	Q-E	-589/0	0.31 (1)			
F-G	-1921/0	-91.8	-91.8	0.37 (1)	4.49	E-P	-3/0	0.00 (1)			
G-H	-1921/0	-91.8	-91.8	0.40 (1)	4.45	P-G	-568/0	0.31 (1)			
H-I	-1957/0	-91.8	-91.8	0.28 (1)	4.57	P-H	0/807	0.12 (1)			
I-J	-1894/0	-91.8	-91.8	0.30 (1)	4.53	N-I	0/189	0.05 (4)			
J-K	0/41	-91.8	-91.8	0.13 (1)	10.00	N-I	-121/0	0.10 (1)			
U-B	-2028/0	0.0	0.0	0.22 (1)	5.94	M-I	-353/0	0.16 (1)			
L-J	-2028/0	0.0	0.0	0.22 (1)	5.94	B-T	0/1617	0.36 (1)			
						M-J	0/1617	0.36 (1)			
U-T	0/0	-18.5	-18.5	0.08 (4)	10.00						
T-S	0/1555	-18.5	-18.5	0.30 (1)	10.00						
S-R	0/1477	-18.5	-18.5	0.30 (1)	10.00						
R-Q	0/1477	-18.5	-18.5	0.30 (1)	10.00						
Q-P	0/1923	-18.5	-18.5	0.38 (1)	10.00						
P-O	0/1478	-18.5	-18.5	0.30 (1)	10.00						
O-N	0/1478	-18.5	-18.5	0.30 (1)	10.00						
N-M	0/1555	-18.5	-18.5	0.31 (1)	10.00						
M-L	0/0	-18.5	-18.5	0.08 (4)	10.00						

TOTAL WEIGHT = 2 X 182 = 363 lb

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL =	25.6 PSF
DL =	8.0 PSF
BOT CH. LL =	0.0 PSF
DL =	7.4 PSF
TOTAL LOAD =	39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CSI: TC=0.40/1.00 (D-E:1), BC=0.38/1.00 (P-Q:1), WB=0.38/1.00 (B-T:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 L5 BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1587 788 1997 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (B) (INPUT = 0.90)
JSI METAL= 0.50 (O) (INPUT = 1.00)




Structural component only
DWG# T-2007135

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T7	5	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Col 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:58 2020 Page 1
ID:DMCubINVR6TslF0e31v8l_zns1l-79GkVnMUS9qHmXpQRO9reikDmackeFmWKLx_zNBRD

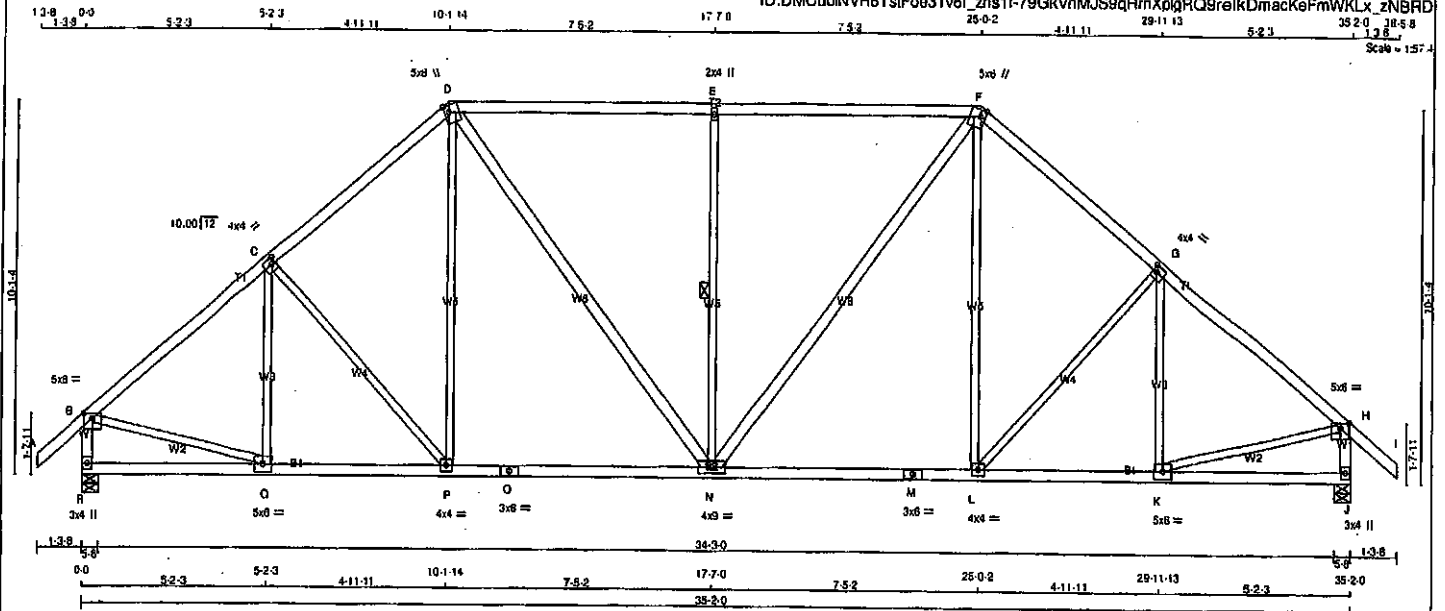

TOTAL WEIGHT = 5 X 173 = 867 lb
(M/F)

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
O - O	2x4	DRY	No.2
R - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	X
B	TMWV-p	MT20	5.0	6.0	1.50 3.00
C	TMWV-t	MT20	4.0	4.0	2.00 1.25
D	TTWV+m	MT20	5.0	6.0	2.25 1.50
E	TMWV-w	MT20	2.0	4.0	
F	TTWV+m	MT20	5.0	6.0	2.25 1.50
G	TMWV-t	MT20	4.0	4.0	2.00 1.25
H	TMWV-p	MT20	5.0	6.0	1.50 3.00
J	BMV1+p	MT20	3.0	4.0	
K	BMWV-t	MT20	5.0	6.0	
L	BMWV-t	MT20	4.0	4.0	
M	BS-t	MT20	3.0	6.0	
N	BMWVW-t	MT20	4.0	9.0	
O	BS-t	MT20	3.0	6.0	
P	BMWV-t	MT20	4.0	4.0	
Q	BMWV-t	MT20	5.0	6.0	
R	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED	MAXIMUM FACTORED	INPUT	REQD	
	GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	HORIZ	UPLIFT
R	2068	0	2068	0	0
J	2068	0	2068	0	0

UNFACTORED REACTIONS						
1ST CASE	MAX/MIN	COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
R	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0
J	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.98 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. (PLF)	FACTORED LC1 MAX (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH
FR-TO		FROM	TO		FR-TO		
A-B	0 / 41	-91.8	-91.8 0.13 (1)	10.00	Q-C	-302 / 0	0.17 (1)
B-C	-2021 / 0	-91.8	-91.8 0.39 (1)	4.41	G-P	-217 / 0	0.25 (1)
C-D	-1908 / 0	-91.8	-91.8 0.37 (1)	4.52	P-D	0 / 278	0.08 (1)
D-E	-1809 / 0	-91.8	-91.8 0.74 (1)	3.98	D-N	0 / 615	0.10 (1)
E-F	-1809 / 0	-91.8	-91.8 0.74 (1)	3.98	N-E	-838 / 0	0.58 (1)
F-G	-1808 / 0	-91.8	-91.8 0.37 (1)	4.52	N-F	0 / 615	0.10 (1)
G-H	-2021 / 0	-91.8	-91.8 0.39 (1)	4.41	L-F	-0 / 278	0.06 (1)
H-I	0 / 41	-91.8	-91.8 0.13 (1)	10.00	L-G	-217 / 0	0.25 (1)
R-B	-2024 / 0	0.0	0.0 0.22 (1)	5.94	K-G	-302 / 0	0.17 (1)
J-H	-2024 / 0	0.0	0.0 0.22 (1)	5.94	B-Q	0 / 1629	0.37 (1)
					K-H	0 / 1629	0.37 (1)
R-Q	0 / 0	-18.5	-18.5 0.10 (4)	10.00			
Q-P	0 / 1580	-18.5	-18.5 0.34 (1)	10.00			
P-O	0 / 1437	-18.5	-18.5 0.35 (1)	10.00			
O-N	0 / 1437	-18.5	-18.5 0.35 (1)	10.00			
N-M	0 / 1437	-18.5	-18.5 0.35 (1)	10.00			
M-L	0 / 1437	-18.5	-18.5 0.35 (1)	10.00			
L-K	0 / 1580	-18.5	-18.5 0.34 (1)	10.00			
K-J	0 / 0	-18.5	-18.5 0.10 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = 1/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.17)
CALCULATED VERT. DEFL.(TL) = 1/999 (0.17")

CSI: TC=0.74/1.00 (D-E:1), BC=0.35/1.00 (L-N:1), WB=0.58/1.00 (E-N:1), SSI=0.39/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (H) (INPUT = 0.90)
JSI METAL= 0.46 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007136

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408168	T8	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:34:57 2020 Page 1
ID:DMCubINVR6TstFoe31v6i_zns11-bLq6j7MyDTz8T8x67JNyh3A_Cc6BLq307A4vTQzNBRC

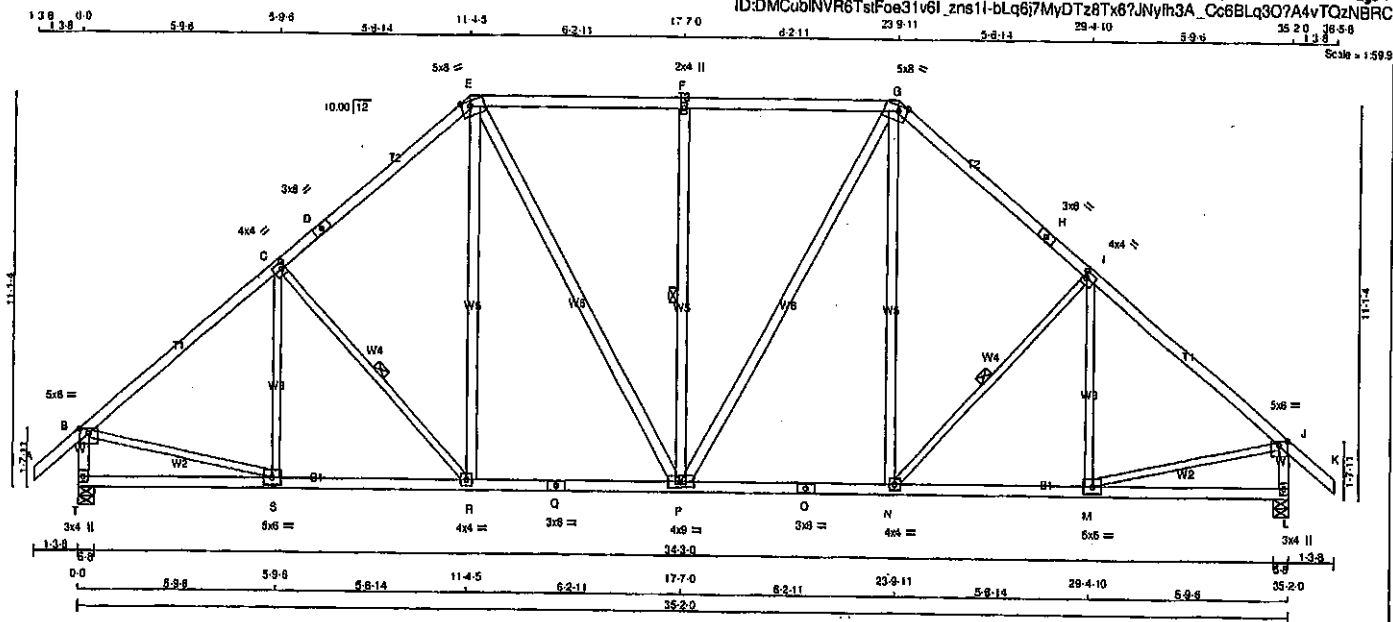

LUMBER	N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS				
A - D	2x4	DRY	No.2	SPF
E - H	2x4	DRY	No.2	SPF
I - J	2x4	DRY	No.2	SPF
K - L	2x4	DRY	No.2	SPF
M - N	2x4	DRY	No.2	SPF
O - P	2x4	DRY	No.2	SPF
Q - R	2x4	DRY	No.2	SPF
S - T	2x4	DRY	No.2	SPF
U - V	2x4	DRY	No.2	SPF
W - X	2x4	DRY	No.2	SPF
ALL WEBS	2x4	DRY	No.2	SPF
EXCEPT				
S - C	2x3	DRY	No.2	SPF
C - R	2x3	DRY	No.2	SPF
N - I	2x3	DRY	No.2	SPF
M - J	2x3	DRY	No.2	SPF
B - S	2x3	DRY	No.2	SPF
M - J	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.50	3.00
C	TMVW-l	MT20	4.0	4.0	2.00	1.25
D	TS-l	MT20	3.0	8.0		
E	TTWW-m	MT20	5.0	8.0	Edge	3.00
F	TMVW-w	MT20	2.0	4.0		
G	TTWW-m	MT20	5.0	8.0	Edge	3.00
H	TS-l	MT20	3.0	8.0		
I	TMVW-l	MT20	4.0	4.0	2.00	1.25
J	TMVW-p	MT20	5.0	8.0	1.50	3.00
L	BMV-l-p	MT20	3.0	4.0		
M	BMVW-l	MT20	5.0	8.0		
N	BMVW-l	MT20	4.0	4.0		
O	BS-l	MT20	3.0	8.0		
P	BMVWW-l	MT20	4.0	9.0		
Q	BS-l	MT20	3.0	8.0		
R	BMVW-l	MT20	4.0	4.0		
S	BMVW-l	MT20	5.0	8.0		
T	BMV-l-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORIZ	DOWN	HORIZ
T	2066	0	2066	0
L	2066	0	2066	0

UNFACTORED REACTIONS

	1ST CASE	MAX/MIN	COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM	LIVE	WIND	DEAD
T	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1458	971 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.27 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-R, F-P, I-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MAX. FACTORED		FACTORED		MAX. FACTORED		FACTORED		
MEMB.	FORCE	VERT. LOAD	LC1 MAX	MEMB.	FORCE	VERT. LOAD	LC1 MAX	
	(LBS)	(PLF)	CSI (LC)		(LBS)	(PLF)	CSI (LC)	
FR-TO		FROM	TO	FR-TO		FROM	TO	
A-B	0 / 41	-91.8	-91.8	0.13 (1)	10.00	S-C	-245 / 10	0.17 (1)
B-C	-2039 / 0	-91.8	-91.8	0.50 (1)	4.27	C-R	-314 / 0	0.15 (1)
C-D	-1844 / 0	-91.8	-91.8	0.48 (1)	4.47	R-E	0 / 338	0.05 (1)
D-E	-1844 / 0	-91.8	-91.8	0.48 (1)	4.47	E-P	0 / 489	0.08 (1)
E-F	-1821 / 0	-91.8	-91.8	0.50 (1)	4.60	P-F	-699 / 0	0.45 (1)
F-G	-1821 / 0	-91.8	-91.8	0.50 (1)	4.60	P-G	0 / 489	0.08 (1)
G-H	-1844 / 0	-91.8	-91.8	0.48 (1)	4.47	N-G	0 / 338	0.05 (1)
H-I	-1844 / 0	-91.8	-91.8	0.48 (1)	4.47	N-I	-314 / 0	0.15 (1)
I-J	-2039 / 0	-91.8	-91.8	0.50 (1)	4.27	M-I	-245 / 10	0.17 (1)
J-K	0 / 41	-91.8	-91.8	0.13 (1)	10.00	B-S	0 / 1637	0.37 (1)
T-B	-2021 / 0	0.0	0.0	0.21 (1)	5.94	M-J	0 / 1637	0.37 (1)
L-J	-2021 / 0	0.0	0.0	0.21 (1)	5.94			
T-S	0 / 0	-18.5	-18.5	0.14 (4)	10.00			
S-R	0 / 1597	-18.5	-18.5	0.33 (1)	10.00			
R-Q	0 / 1387	-18.5	-18.5	0.30 (1)	10.00			
Q-P	0 / 1387	-18.5	-18.5	0.30 (1)	10.00			
P-O	0 / 1387	-18.5	-18.5	0.30 (1)	10.00			
O-N	0 / 1387	-18.5	-18.5	0.30 (1)	10.00			
N-M	0 / 1597	-18.5	-18.5	0.33 (1)	10.00			
M-L	0 / 0	-18.5	-18.5	0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/989 (0.07")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/989 (0.14")

CS1: TC=0.50/1.00 (E-F:1), BC=0.33/1.00 (M-N:1), WB=0.45/1.00 (F-P:1), SS1=0.28/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.89 (J) (INPUT = 0.90)
JSI METAL=0.47 (O) (INPUT = 1.00)




Structural component only
DWG# T-2007137

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408168	T9	6	1	TRUSS DESC.		

Tamarrack Roof Truss, Burlington

Version 8.310.9 Oct 29 2019 MTek Industries, Inc. Sat Apr 25 12:34:56 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns1I-3XOUwSNa_n5765hBISUuEGiD_OUq4EhYDqpS7tzNBRB

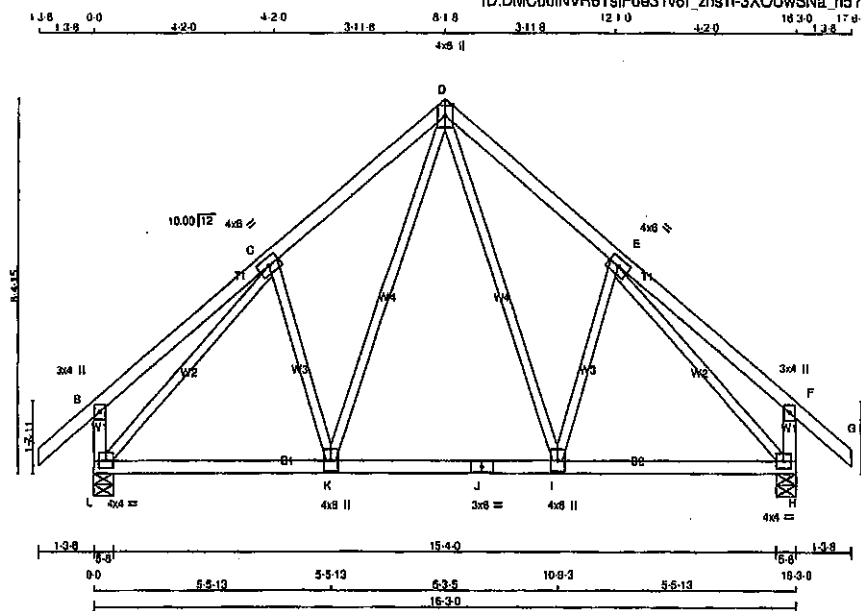

TOTAL WEIGHT = 6 X 80 = 481 lb

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
BT TYPE PLATES				
B TMV+p	MT20	3.0	4.0	
C TMWW-t	MT20	4.0	8.0	
D TTWW+p	MT20	4.0	8.0	Edge
E TMWW-t	MT20	4.0	8.0	
F TMV+p	MT20	3.0	4.0	
H BMVW1-t	MT20	4.0	4.0	
I BMVW-t	MT20	4.0	8.0	
J BS-t	MT20	3.0	8.0	
K BMVW-t	MT20	4.0	8.0	
L BMVW1-t	MT20	4.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
L	1023	0	1023	0
H	1023	0	1023	0

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	721	487 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0
H	721	487 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 41	-91.8	-91.8 0.13 (1)	D-I	0 / 330	0.07 (1)	
B-C	0 / 28	-91.8	-91.8 0.24 (1)	I-E	-216 / 0	0.09 (1)	
C-D	-745 / 0	-91.8	-91.8 0.19 (1)	K-D	0 / 330	0.07 (1)	
D-E	-745 / 0	-91.8	-91.8 0.19 (1)	C-K	-216 / 0	0.09 (1)	
E-F	0 / 28	-91.8	-91.8 0.24 (1)	L-C	-943 / 0	0.81 (1)	
F-G	0 / 41	-91.8	-91.8 0.13 (1)	E-H	-943 / 0	0.81 (1)	
L-B	-267 / 0	0.0	0.0 0.03 (1)				
H-F	-267 / 0	0.0	0.0 0.03 (1)				
L-K	0 / 616	-18.5	-18.5 0.17 (4)				
K-J	0 / 449	-18.5	-18.5 0.16 (4)				
J-I	0 / 449	-18.5	-18.5 0.16 (4)				
I-H	0 / 616	-18.5	-18.5 0.17 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL = 6.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD = 38.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.24/1.00 (B-C:1), BC=0.17/1.00 (H-I:4),
WB=0.61/1.00 (C-L:1), SSI=0.14/1.00 (C-D:1)

DCX LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	610 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.76 (C) (INPUT = 0.90)
JSI METAL= 0.25 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007138

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T10	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Sat Apr 25 12:34:59 2020 Page 1
ID:DMCubINVR6TsIFoe31v6l_zns11-Xjys8o0C4DsIFFNQo?7nUGOUQrOpqnhSUZ?XJzNBRIA

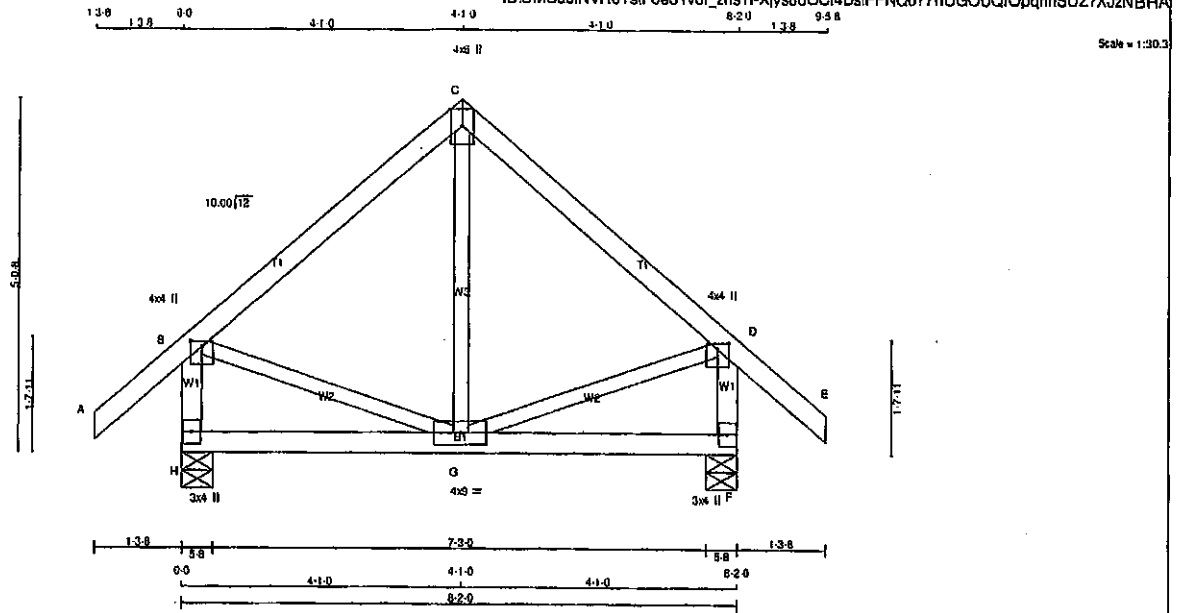

TOTAL WEIGHT = 38 lb (M)F

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES				
A - C	2x4	ORY	No.2	SPF
C - E	2x4	ORY	No.2	SPF
H - B	2x4	ORY	No.2	SPF
F - D	2x4	ORY	No.2	SPF
H - F	2x4	ORY	No.2	SPF
ALL WEBS	2x3	ORY	No.2	SPF
EXCEPT				

DRY; SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW+p	MT20	4.0	6.0	Edge	
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVWV-t	MT20	4.0	9.0		
H	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT VERT	HORZ	DOWN	HORZ	UPLIFT
H	577	0	577	0
F	577	0	577	0

UNFACTORED REACTIONS							
	1ST CASE	MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SO
H	406	280 / 0	0 / 0	0 / 0	0 / 0	128 / 0	0 /
F	406	280 / 0	0 / 0	0 / 0	0 / 0	126 / 0	0 /

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING	CHORDS	WEBS
TOTAL LOAD CASES: (4)	MAX. FACTORED	MAX. FACTORED
MEMB.	FORCE (LBS)	FORCE (LBS)
FR-TO	FROM	TO
A-B	0 / 41	-91.8 -91.8 0.13 (1)
B-C	-284 / 0	-91.8 -91.8 0.20 (1)
C-D	-284 / 0	-91.8 -91.8 0.20 (1)
D-E	0 / 41	-91.8 -91.8 0.13 (1)
H-B	-548 / 0	0.0 0.0 0.06 (1)
F-D	-548 / 0	0.0 0.0 0.06 (1)
H-G	0 / 0	-18.5 -18.5 0.09 (4)
G-F	0 / 0	-18.5 -18.5 0.09 (4)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN.CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.27")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.27")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.01")

CSI: TC=0.20/1.00 (B-C:1), BC=0.09/1.00 (F-G:4), WB=0.05/1.00 (D-G:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1967 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.46 (D) (INPUT = 0.90)
JSI METAL= 0.12 (D) (INPUT = 1.00)

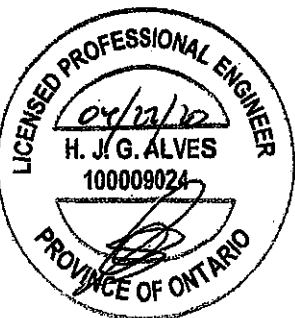

Structural component only
DWG# T-2007139

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	G10	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 5 Oct 2019 MITek Industries, Inc. Sat Apr 25 12:34:41 2020 Page 1	

ID:DMCubINVR8TsiFoe31v6I_zns1k-3Gs3MeAv_YyQYUwN0gv2hWL7AicChL2JgC3vMzNBRS

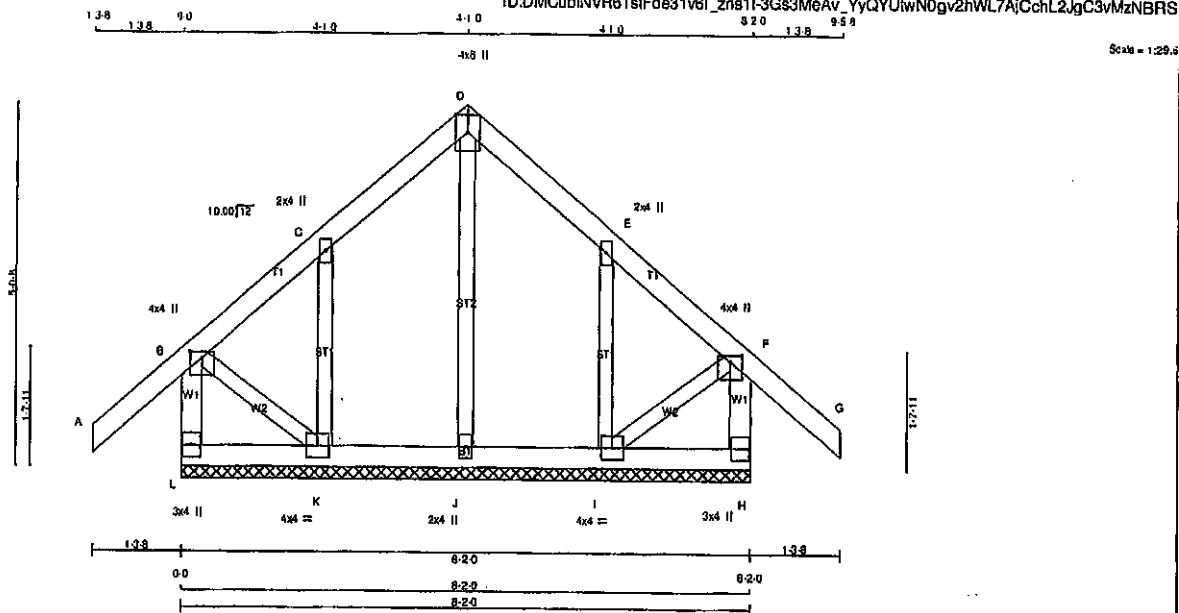

TOTAL WEIGHT = 40 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
L - B	2x4	DRY	No.2
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			
GABLE STUDS SPACED AT 2-0-0 OC.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (A-B:1), BC=0.02/1.00 (J-K:4), WB=0.05/1.00 (D-J:1), SS=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(FSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1667 788 1967 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (C) (INPUT = 0.90)

JSI METAL= 0.12 (C) (INPUT = 1.00)


PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
C	TMVW+w	MT20	2.0	4.0	
D	TMVW+p	MT20	4.0	6.0	Edge
E	TMVW+w	MT20	2.0	4.0	
F	TMVW+p	MT20	4.0	4.0	1.00 2.00
H	BMV1+p	MT20	3.0	4.0	
I	BMVW1-t	MT20	4.0	4.0	
J	BMV1+w	MT20	2.0	4.0	
K	BMVW1-t	MT20	4.0	4.0	
L	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)


CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	UNBRAC LENGTH
FR-TO		FROM TO		FR-TO			
L-B	-224 / 0	0.0	0.0 0.02 (1)	J-D	-128 / 0	0.05 (1)	
A-B	0 / 41	-91.8	-91.8 0.13 (1)	K-C	-227 / 0	0.04 (1)	
B-C	-11 / 0	-91.8	-91.8 0.06 (1)	I-E	-227 / 0	0.04 (1)	
C-D	-31 / 0	-91.8	-91.8 0.06 (1)	B-K	0 / 24	0.01 (1)	
D-E	-31 / 0	-91.8	-91.8 0.06 (1)	I-F	0 / 24	0.01 (1)	
E-F	-11 / 0	-91.8	-91.8 0.06 (1)				
F-G	0 / 41	-91.8	-91.8 0.13 (1)				
H-F	-224 / 0	0.0	0.0 0.02 (1)				
L-K	0 / 0	-18.5	-18.5 0.02 (4)				
K-J	0 / 13	-18.5	-18.5 0.02 (4)				
J-I	0 / 13	-18.5	-18.5 0.02 (4)				
I-H	0 / 0	-18.5	-18.5 0.02 (4)				

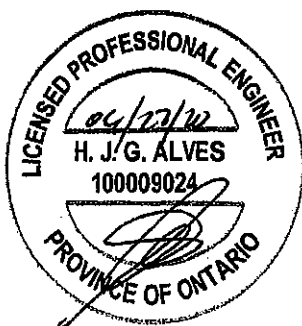

Structural component only
DWG# T-2007124

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408168	T11	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:35:00 2020 Page 1	

ID:DMCubINVR6TsIFoe31v6I_zns11-7wWEL8PqVOLIKPqa_WWWJhoZlq8hYBarh8IZ4IzNB89

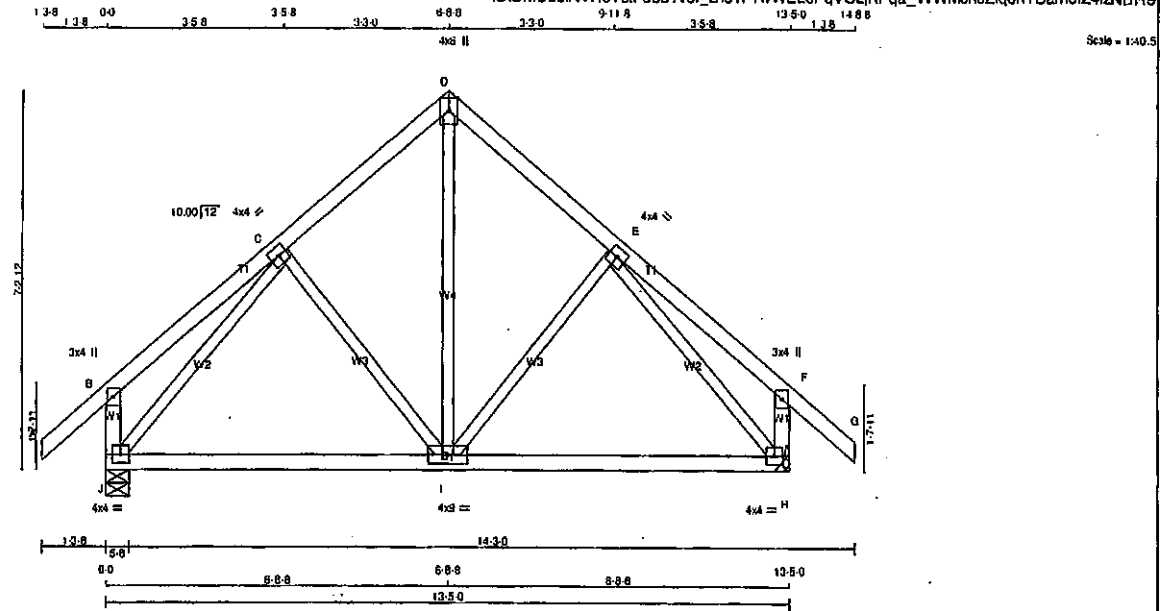

TOTAL WEIGHT = 3 X 64 = 191 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4 DRY	No.2	SPF		
D - G	2x4 DRY	No.2	SPF		
J - B	2x4 DRY	No.2	SPF		
H - F	2x4 DRY	No.2	SPF		
J - H	2x4 DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-i	MT20	4.0	4.0		
D	TTW+p	MT20	4.0	8.0	Edge	
E	TMVW-i	MT20	4.0	4.0		
F	TMV+p	MT20	3.0	4.0		
H	BMVW1-i	MT20	4.0	4.0		
I	BMVW1-i	MT20	4.0	9.0		
J	BMVW1-i	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORIZ	UPLIFT
J	887	0	887	0
H	887	0	887	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW
J	811	414 / 0
H	811	414 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 / 41	-91.8 -91.8 0.13 (1)	1-D	0 / 382
B-C	0 / 23	-91.8 -91.8 0.16 (1)	1-E	-149 / 0
C-D	-508 / 0	-91.8 -91.8 0.13 (1)	C-I	-149 / 0
D-E	-508 / 0	-91.8 -91.8 0.13 (1)	J-C	-742 / 0
E-F	0 / 23	-91.8 -91.8 0.16 (1)	E-H	-742 / 0
F-G	0 / 41	-91.8 -91.8 0.13 (1)		
J-B	-244 / 0	0.0 0.0 0.03 (1)		
H-F	-244 / 0	0.0 0.0 0.03 (1)		
J-I	0 / 469	-18.5 -18.5 0.27 (4)		
I-H	0 / 469	-18.5 -18.5 0.27 (4)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.45")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.45")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CS: TO=0.16/1.00 (E-F:1), BC=0.27/1.00 (I-J:4), WB=0.33/1.00 (E-H:1), SS=0.11/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (ORY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1686

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP = 0.84 (E) (INPUT = 0.90)
JSI METAL = 0.27 (E) (INPUT = 1.00)

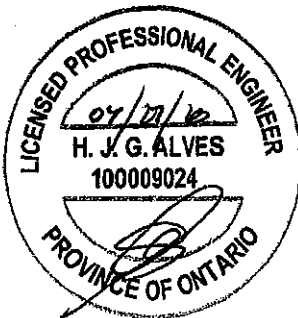

Structural component only
DWG# T-2007140

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ORWG NO.
408168	G11	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mike Industries, Inc. Sat Apr 25 12:34:42 2020 Page 1
ID:DMCubINVR6T9tF0e31v6I_zns11-XSORZ_BXIs4GAeS6xkBBau3W1Z3HL6XBYKxcRozNBRR

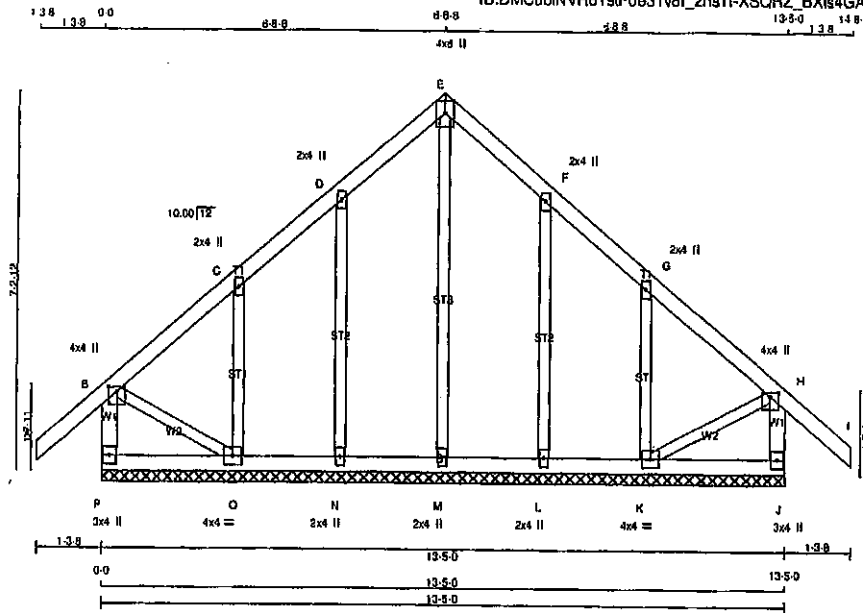

Scale = 1:10.5

TOTAL WEIGHT = 65 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
P - B	2x4	DRY	No.2
A - E	2x4	DRY	No.2
E - I	2x4	DRY	No.2
J - H	2x4	DRY	No.2
P - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			
GABLE STUDS SPACED AT 2-0-0 OC.			

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
S TMW+p	MT20	4.0	4.0	1.00	2.00
C, D, F, G					
C TMW+w	MT20	2.0	4.0		
E TTW+p	MT20	4.0	6.0	Edge	
H TMW+p	MT20	4.0	4.0	1.00	2.00
J BMV1+p	MT20	3.0	4.0		
K BMW1-i	MT20	4.0	4.0		
L, M, N					
L BMW1+w	MT20	2.0	4.0		
O BMW1-i	MT20	4.0	4.0		
P BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED GSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED GSI (LC)	
FR-TO		FROM TO		FR-TO			
P-B	-263 / 0	0.0	0.0 0.03 (1)	M-E	-128 / 0	0.11 (1)	
A-B	0 / 41	-91.8	-91.8 0.13 (1)	N-D	-190 / 0	0.09 (1)	
S-C	-24 / 0	-91.8	-91.8 0.08 (1)	D-C	-239 / 0	0.08 (1)	
C-D	-38 / 0	-91.8	-91.8 0.08 (1)	L-F	-190 / 0	0.09 (1)	
D-E	-35 / 0	-91.8	-91.8 0.05 (1)	K-G	-239 / 0	0.08 (1)	
E-F	-35 / 0	-91.8	-91.8 0.05 (1)	B-O	0 / 32	0.01 (1)	
F-G	-36 / 0	-91.8	-91.8 0.08 (1)	K-H	0 / 32	0.01 (1)	
G-H	-24 / 0	-91.8	-91.8 0.08 (1)				
H-I	0 / 41	-91.8	-91.8 0.13 (1)				
J-H	-263 / 0	0.0	0.0 0.03 (1)				
P-O	0 / 0	-18.5	-18.5 0.03 (4)				
O-N	0 / 22	-18.5	-18.5 0.03 (4)				
N-M	0 / 19	-18.5	-18.5 0.02 (4)				
M-L	0 / 19	-18.5	-18.5 0.02 (4)				
L-K	0 / 22	-18.5	-18.5 0.03 (4)				
K-J	0 / 0	-18.5	-18.5 0.03 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019

- PART 9 OF OBC 2012 (2019 AMENDMENT)

- CSA 088-09, CSA 088-14

- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (H-I:1), BC=0.03/1.00 (K-L:4), WB=0.11/1.00 (E-M:1), SSI=0.08/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.20 (B) (INPUT = 0.90)

JSI METAL= 0.13 (G) (INPUT = 1.00)



Structural component only
DWG# T-2007125

JOB NAME 408168	TRUSS NAME T12	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:35:01 2020 Page 1	
				ID:DMCubINVR6TstFoe31v6l_zns1f-T63dYUPSGiYayZPmyD1bsvLjXEW1HhI_vn26cCzNBR8	
Scale = 1:18.8					

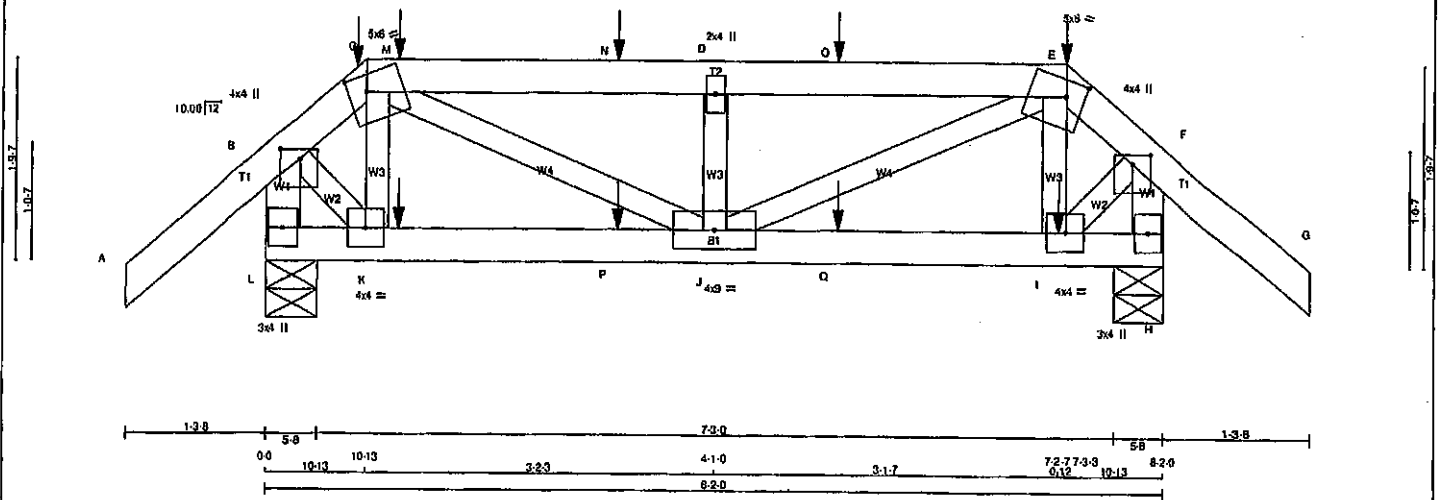

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW+p	MT20	4.0	4.0 1.00 2.00
C	TTWW-m	MT20	5.0	6.0 1.75 2.00
D	TMVW+w	MT20	2.0	4.0
E	TTWW-m	MT20	5.0	6.0 1.75 2.00
F	TMVW+p	MT20	4.0	4.0 1.00 2.00
H	BMV1+p	MT20	3.0	4.0
I	BMVW-1	MT20	4.0	4.0
J	BMVW-1	MT20	4.0	9.0
K	BMVW-1	MT20	4.0	4.0
L	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	GROSS REACTION	DOWN	BRG	BRG
L	913	0	913	0	5-8
H	911	0	911	0	5-8

UNFACTORED REACTIONS		1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	642	442 / 0	0 / 0	0 / 0	0 / 0	0 / 0	189 / 0	0 / 0
L	641	437 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	204 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.82 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED	FACTORED	VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH	WEBS	MAX. FACTORED	MAX. CS1 (LC)
MEMB.	FR-TO	FORCE (LBS)	FROM	TO			MEMB.	FORCE (LBS)	
A-B	0 / 41	-91.8	-91.8	0.14 (1)	10.00	J-D	-487 / 0	0.08 (1)	
B-C	-631 / 0	-91.8	-91.8	0.14 (1)	6.25	K-O	-156 / 0	0.02 (1)	
C-M	-1054 / 0	-91.8	-91.8	0.23 (1)	5.82	C-J	0 / 700	0.17 (1)	
M-N	-1054 / 0	-91.8	-91.8	0.23 (1)	5.82	B-K	0 / 525	0.13 (1)	
N-D	-1054 / 0	-91.8	-91.8	0.23 (1)	5.82	I-E	-149 / 0	0.02 (1)	
D-O	-1054 / 0	-91.8	-91.8	0.23 (1)	5.82	J-E	0 / 688	0.17 (1)	
O-E	-1054 / 0	-91.8	-91.8	0.23 (1)	5.82	I-F	0 / 526	0.13 (1)	
E-F	-832 / 0	-91.8	-91.8	0.14 (1)	6.25				
F-G	0 / 41	-91.8	-91.8	0.14 (1)	10.00				
L-B	-836 / 0	0.0	0.0	0.10 (1)	7.81				
H-F	-837 / 0	0.0	0.0	0.10 (1)	7.81				
L-K	0 / 0	-18.5	-18.5	0.05 (1)	10.00				
K-P	0 / 420	-18.5	-18.5	0.13 (1)	10.00				
P-J	0 / 420	-18.5	-18.5	0.13 (1)	10.00				
J-Q	0 / 421	-18.5	-18.5	0.14 (1)	10.00				
Q-I	0 / 421	-18.5	-18.5	0.14 (1)	10.00				
I-H	0 / 0	-18.5	-18.5	0.05 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)		LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
JT	LOC.	LC1	MAX.	MAX.						
C	10-13	-9	-10			FRONT	VERT	DEAD		C1
C	1-2-7	-114	-114			BACK	VERT	TOTAL		C1
C	10-13	-44	-44			FRONT	VERT	SNOW		C1
E	7-3-3	-9	-10			FRONT	VERT	DEAD		C1
E	7-3-3	-90	-90			BACK	VERT	TOTAL		C1
E	7-3-3	-44	-44			FRONT	VERT	SNOW		C1
I	7-2-7	-49	-49			BACK	VERT	TOTAL		C1
K	1-2-7	-49	-49			BACK	VERT	TOTAL		C1
N	3-2-7	-82	-82			BACK	VERT	TOTAL		C1
O	5-2-7	-82	-82			BACK	VERT	TOTAL		C1
P	3-2-7	-49	-49			BACK	VERT	TOTAL		C1
Q	5-2-7	-49	-49			BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.27")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.27")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.03")

CS1: TC=0.23/1.00 (C-D:1), BC=0.14/1.00 (I-J:1), WB=0.17/1.00 (C-J:1), SS1=0.22/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1667 768 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.




Structural component only
DWG# T-2007141

CONTINUED ON PAGE 2

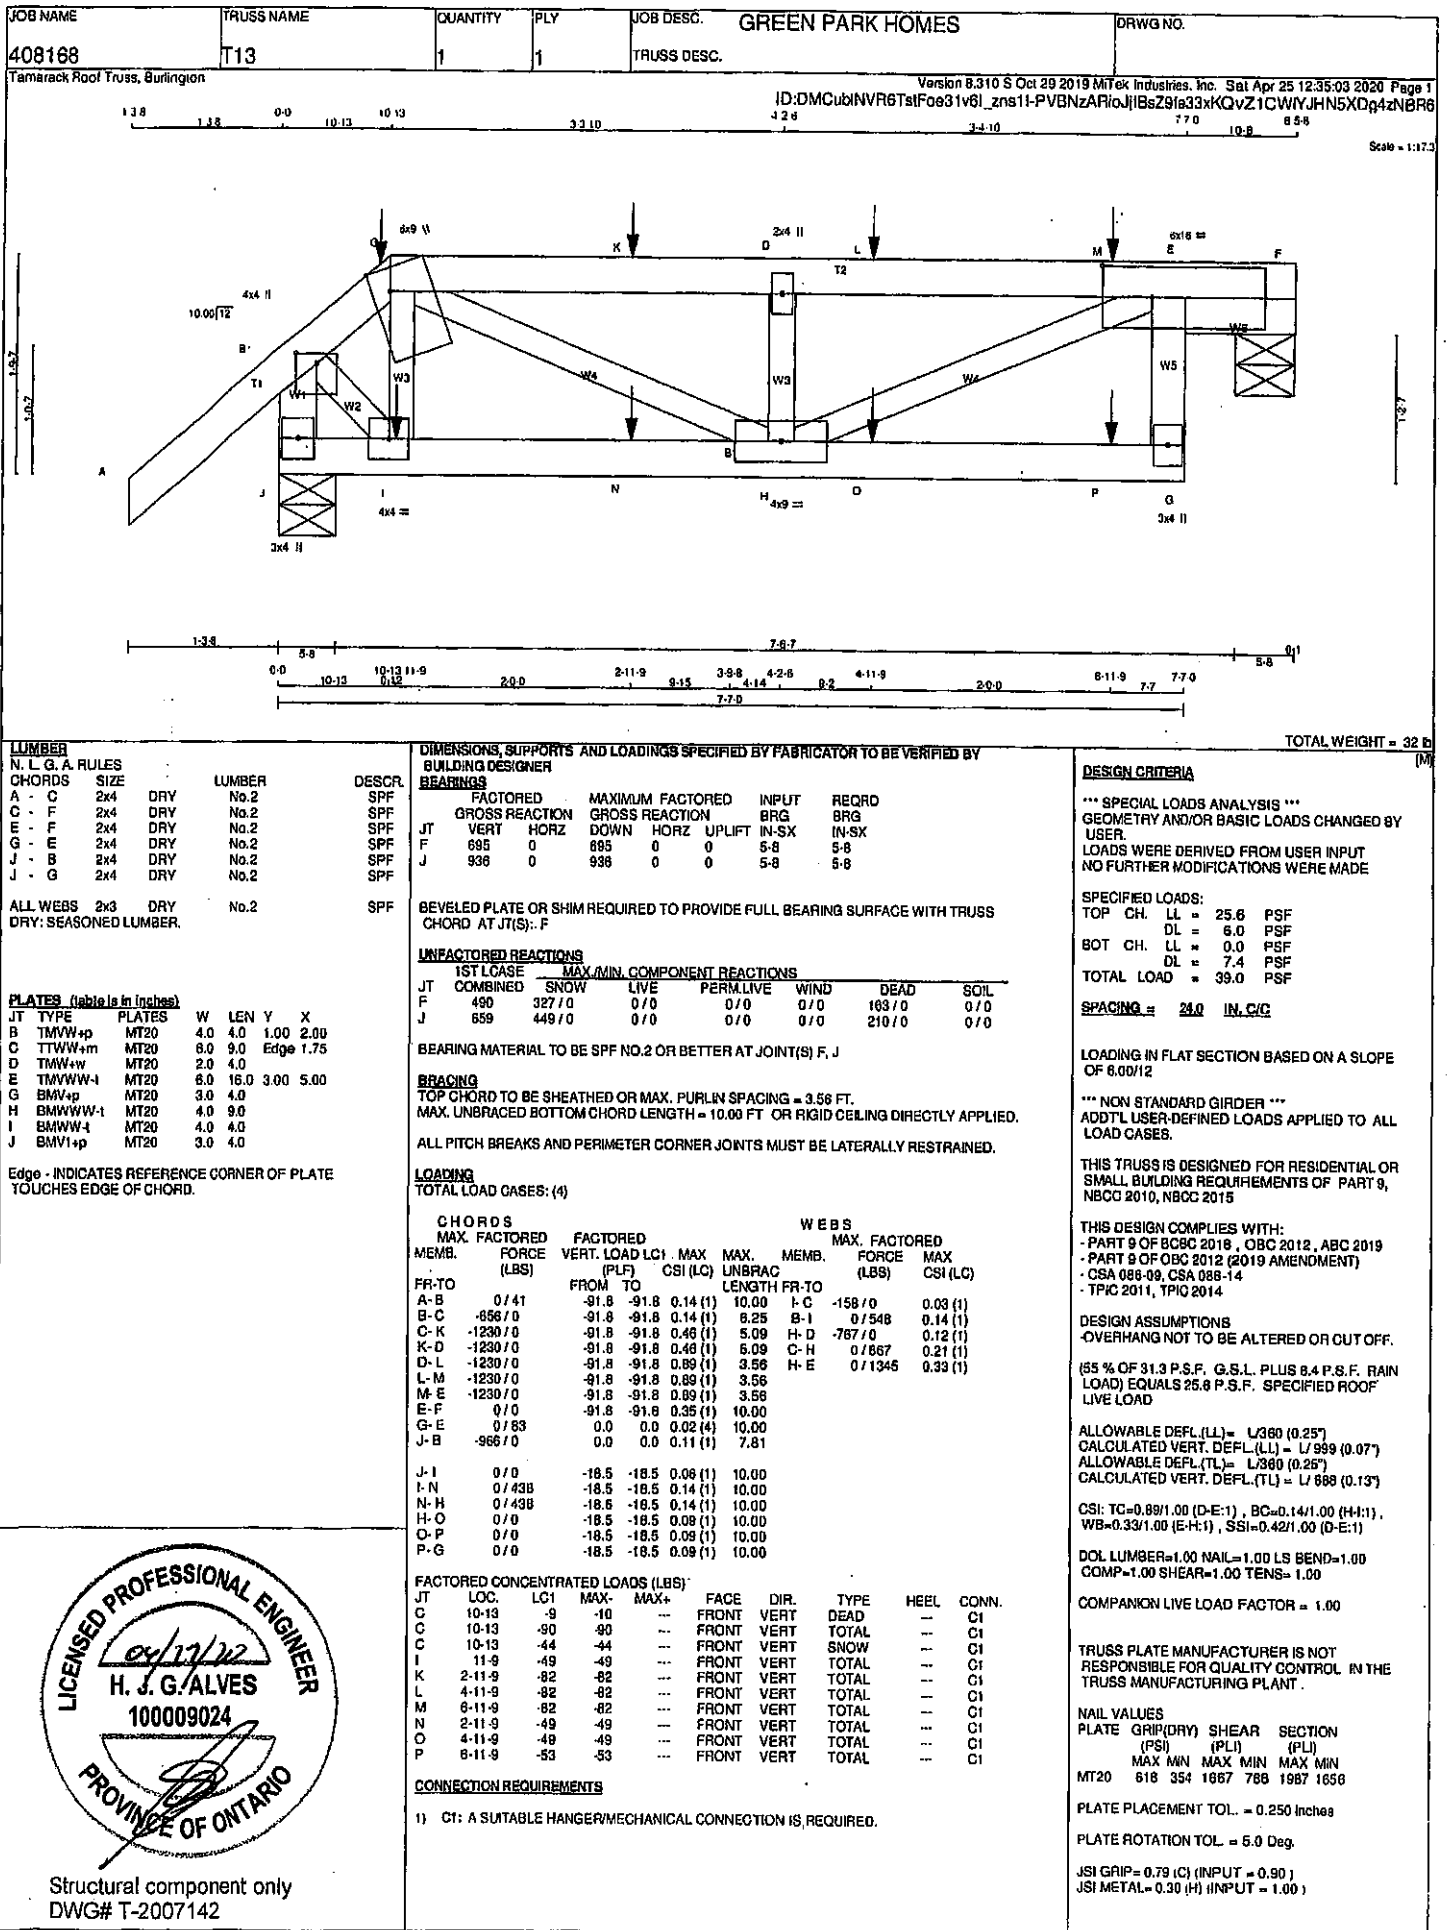

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T20	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:49:24 2020 Page 1
ID:K7TPdhgOnp1qYdbWIOFzIdG-i8jlgasnl8B7_Budbz0zKub4B6zN_Xr0MZbHOGznBD0

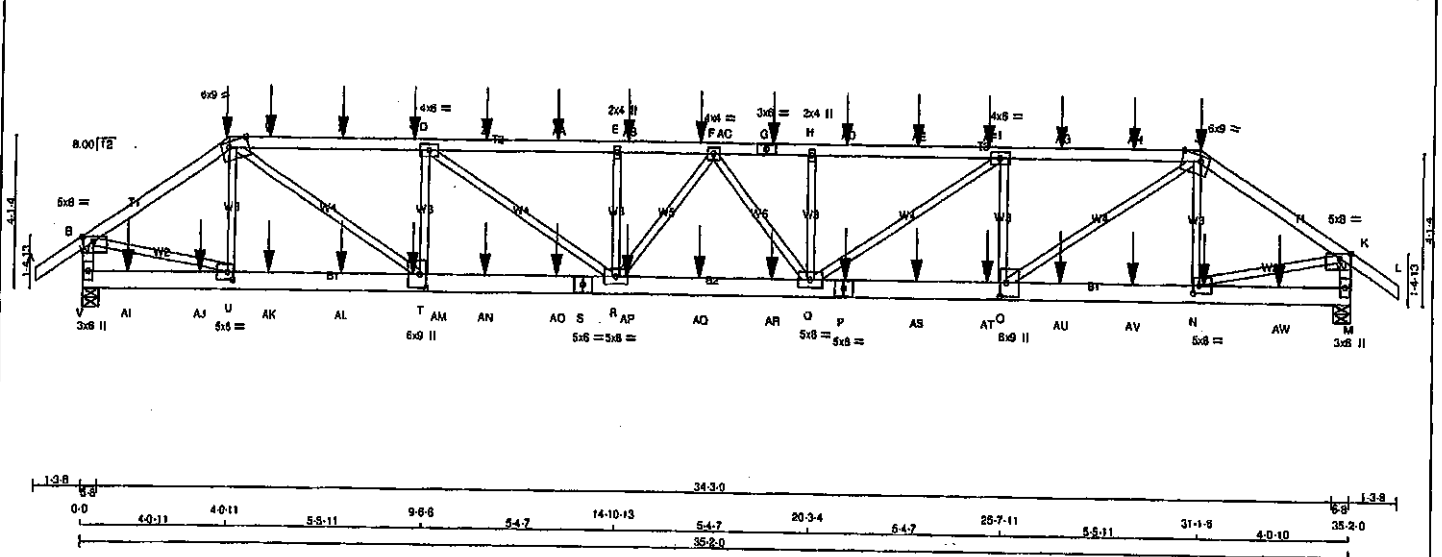

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - G	2x4	DRY No.2	SPF
G - J	2x4	DRY No.2	SPF
J - L	2x4	DRY No.2	SPF
V - B	2x4	DRY No.2	SPF
M - K	2x4	DRY No.2	SPF
V - S	2x6	DRY No.2	SPF
S - P	2x6	DRY No.2	SPF
P - M	2x6	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY, SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS: (0.122'X3') SPIRAL NAILS		
A-C	12	SIDE(61.0)
C-G	12	SIDE(61.0)
G-J	12	SIDE(61.0)
J-L	12	SIDE(61.0)
V-B	12	TOP
M-K	12	TOP
BOTTOM CHORDS: (0.122'X3') SPIRAL NAILS		
V-S	2	SIDE(183.1)
S-P	2	SIDE(183.1)
P-M	2	SIDE(183.1)
WEBS: (0.122'X3') SPIRAL NAILS		
2x3	1	8

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT VERT 3342	DOWN 3342	0	5-8
M VERT 3393	DOWN 3393	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX/MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
JT COMBINED	SNOW LIVE PERM.LIVE	0/0	0/0	0/0
V	2363 1555/0	0/0	808/0	0/0
M	2397 1585/0	0/0	812/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSF (LC)	MAX. UNBRACED LENGTH	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSF (LC)
FR-TO					FR-TO		
A-B	0/35	-91.8	-91.8	0.07 (1)	10.00	U-C	-598/0
B-C	-3951/0	-91.8	-91.8	0.22 (1)	4.58	C-T	0/3530
C-W	-6186/0	-91.8	-91.8	0.61 (1)	3.41	T-D	-1829/0
W-X	-6186/0	-91.8	-91.8	0.61 (1)	3.41	D-R	0/1802
X-Y	-6186/0	-91.8	-91.8	0.61 (1)	3.41	R-E	-802/0
Y-D	-6186/0	-91.8	-91.8	0.61 (1)	3.41	Q-H	-598/0
D-Z	-7502/0	-91.8	-91.8	0.37 (1)	3.03	Q-I	0/1573
Z-AA	-7502/0	-91.8	-91.8	0.71 (1)	3.03	O-I	-1808/0
AA-E	-7502/0	-91.8	-91.8	0.71 (1)	3.03	O-J	0/3493
E-AB	-7502/0	-91.8	-91.8	0.35 (1)	3.33	N-J	-616/0
AB-AC	-7502/0	-91.8	-91.8	0.35 (1)	3.33	B-U	0/3374
AC-F	-7502/0	-91.8	-91.8	0.35 (1)	3.33	N-K	0/3439
F-G	-7509/0	-91.8	-91.8	0.37 (1)	3.31	R-F	-179/0
G-H	-7509/0	-91.8	-91.8	0.37 (1)	3.31	F-Q	-166/0
H-AD	-7509/0	-91.8	-91.8	0.71 (1)	3.03		
AD-AE	-7509/0	-91.8	-91.8	0.71 (1)	3.03		
AE-AF	-7509/0	-91.8	-91.8	0.71 (1)	3.03		
AF-I	-7509/0	-91.8	-91.8	0.71 (1)	3.03		
I-AG	-6217/0	-91.8	-91.8	0.61 (1)	3.41		
AG-AH	-6217/0	-91.8	-91.8	0.61 (1)	3.41		
AH-J	-6217/0	-91.8	-91.8	0.61 (1)	3.41		
J-K	-4025/0	-91.8	-91.8	0.22 (1)	4.55		
K-L	0/35	-91.8	-91.8	0.07 (1)	10.00		
V-B	-3288/0	0.0	0.0	0.76 (1)	6.41		
M-K	-3356/0	0.0	0.0	0.19 (1)	6.36		

V-AI	0/0	-18.5	-18.5	0.05 (4)	10.00
AI-AJ	0/0	-18.5	-18.5	0.05 (4)	10.00
AJ-U	0/0	-18.5	-18.5	0.05 (4)	10.00
U-AK	0/3285	-18.5	-18.5	0.25 (1)	10.00
AK-AL	0/3285	-18.5	-18.5	0.25 (1)	10.00
AL-AM	0/3285	-18.5	-18.5	0.25 (1)	10.00
AM-T	0/3285	-18.5	-18.5	0.25 (1)	10.00
T-AN	0/6186	-18.5	-18.5	0.46 (1)	10.00
AN-AO	0/6186	-18.5	-18.5	0.46 (1)	10.00
AO-S	0/6186	-18.5	-18.5	0.46 (1)	10.00
S-R	0/6186	-18.5	-18.5	0.46 (1)	10.00
R-AP	0/7606	-18.5	-18.5	0.56 (1)	10.00
AP-AQ	0/7606	-18.5	-18.5	0.56 (1)	10.00
AQ-AR	0/7606	-18.5	-18.5	0.56 (1)	10.00
AR-Q	0/7606	-18.5	-18.5	0.56 (1)	10.00
Q-P	0/6217	-18.5	-18.5	0.46 (1)	10.00
P-AS	0/6217	-18.5	-18.5	0.46 (1)	10.00

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	25.6	PSF
DL	8.0	PSF	
SOT CH.	LL	0.0	PSF
DL	7.4	PSF	
TOTAL LOAD		39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL. USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2010, NBCO 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.23")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/984 (0.44")

CSI: TC=0.71/1.00 (D-E:1), BC=0.56/1.00 (Q-R:1),
WB=0.44/1.00 (C-T:1), SS=0.23/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788
		1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.71 (3) (INPUT = 0.90)
JSI METAL= 0.59 (5) (INPUT = 1.00)



Structural component only
DWG# T-2007145 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408169	T20	1	2	TRUSS DESC.		
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:24 2020 Page 2		
				ID:K?TPdHgJ0npl1q/YdbWIOFzkdG-i8ltqasnt1sB7 Budbz0zKub4B6zN xrQMZbH0qzNBDI		

PLATES (table in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVV-p	MT20	5.0	8.0	1.50	3.50
C	TTWW-m	MT20	8.0	9.0	Edge 8.25	
D	TMWW-t	MT20	4.0	6.0		
E	TMW-w	MT20	2.0	4.0		
F	TMWW-t	MT20	4.0	4.0		
G	TS-t	MT20	3.0	6.0		
H	TMW-w	MT20	2.0	4.0		
I	TMWW-t	MT20	4.0	6.0		
J	TTWW-m	MT20	8.0	9.0	Edge 8.25	
K	TMVV-p	MT20	5.0	8.0	1.50	3.50
M	BMV1+p	MT20	3.0	6.0		
N	BMWW-t	MT20	5.0	6.0	2.50	2.00
O	BMWW-t	MT20	6.0	9.0	4.50	2.00
P	BS-t	MT20	5.0	8.0		
Q	BMWW-t	MT20	5.0	8.0		
R	BMWW-t	MT20	5.0	8.0		
S	BS-t	MT20	5.0	6.0		
T	BMWW-t	MT20	8.0	9.0	4.50	2.00
U	BMWW-t	MT20	5.0	6.0	2.50	2.00
V	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	FACTORED LC1 (LC)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	FACTORED LC1 (LC)	MAX. CSI (LC)
FR-TO		FROM TO			UNBRAC LENGTH	FR-TO			
AS-AT	0 / 8217	-18.5	-18.5	0.46 (1)	10.00				
AT-O	0 / 8217	-18.5	-18.5	0.46 (1)	10.00				
O-AU	0 / 3326	-18.5	-18.5	0.26 (1)	10.00				
AU-AV	0 / 3326	-18.5	-18.5	0.26 (1)	10.00				
AV-N	0 / 3326	-18.5	-18.5	0.26 (1)	10.00				
N-AW	0 / 0	-18.5	-18.5	0.04 (4)	10.00				
AW-M	0 / 0	-18.5	-18.5	0.04 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-11	-49	-55	---	FRONT	VERT	DEAD	---	C1
C	4-0-11	-254	-254	---	FRONT	VERT	SNOW	---	C1
G	19-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
J	31-1-6	-49	-55	---	FRONT	VERT	DEAD	---	C1
J	31-1-6	-117	-117	---	BACK	VERT	TOTAL	---	C1
J	31-1-6	-254	-254	---	FRONT	VERT	SNOW	---	C1
N	31-2-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
P	21-2-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
W	5-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
X	7-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
Y	9-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
Z	11-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
AA	13-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
AB	15-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
AC	17-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
AD	21-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
AE	23-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
AF	25-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
AG	27-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
AH	29-2-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
AI	1-2-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AJ	3-2-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AK	5-2-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AL	7-2-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AM	9-2-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AN	11-2-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AO	13-2-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AP	15-2-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AQ	17-2-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AR	19-2-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AS	23-2-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AT	25-2-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AU	27-2-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AV	29-2-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AW	33-2-12	-26	-26	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS
1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007145 *HL*

JOB NAME 408169	TRUSS NAME T20Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 12:49:25 2020 Page 2
ID:K7TPdhaiDnpl1atYdbWIOFzIdG-AKHFWuTPa9K ckTp9aXCi67DKWF2Jk9bCKaw7ztNBDe

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	8.0	1.50	3.50
C	TTWW-m	MT20	7.0	8.0	1.75	2.50
D	TMWV-t	MT20	4.0	8.0		
E	TMW-w	MT20	2.0	4.0		
F	TMWW-t	MT20	4.0	4.0		
G	TS-t	MT20	3.0	8.0		
H	TMW-w	MT20	2.0	4.0		
I	TMWV-t	MT20	4.0	8.0		
J	TTWW-m	MT20	7.0	8.0	1.75	2.50
K	TMWV-p	MT20	5.0	8.0	1.50	3.50
M	BMV1-p	MT20	3.0	6.0		
N	BMWW-t	MT20	5.0	6.0	2.50	2.00
O	BMWW-t	MT20	6.0	9.0	4.50	2.00
P	BS-t	MT20	5.0	6.0		
Q	BMWWV-t	MT20	5.0	6.0		
R	BMWWV-t	MT20	5.0	6.0		
S	BS-t	MT20	5.0	6.0		
T	BMWW-t	MT20	6.0	9.0	4.50	2.00
U	BMWW-t	MT20	5.0	6.0	2.50	2.00
V	BMV1-p	MT20	3.0	6.0		

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007146 32

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408169	T21	2	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:26 2020 Page 1
ID:K?TPdngl0npl1qYdbWIOFzIdG-eWrd5Gt2ZTSrDU10J02RPJqOnWdaSrJjs40SZzNBDD

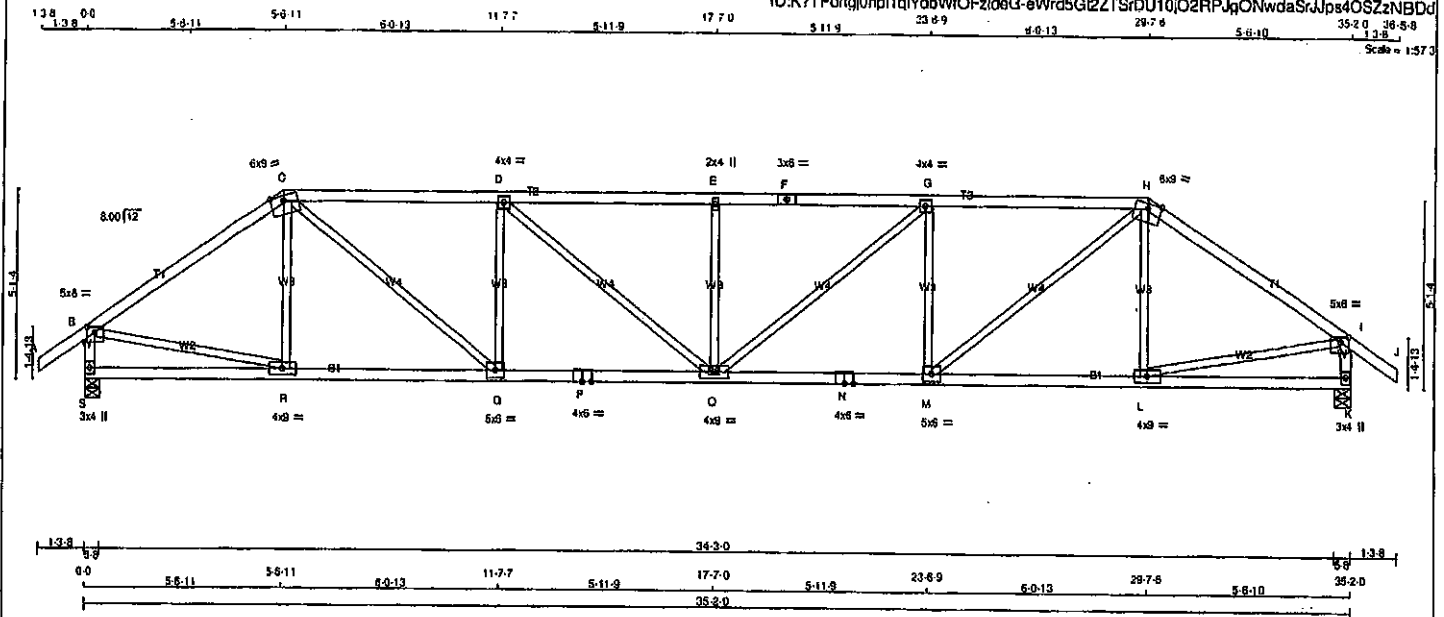

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - O	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
S - P	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW-W-p	MT20	5.0	6.0	1.75	2.75
C	TTWW-m	MT20	5.0	6.0	Edge	
D	TMW-W-i	MT20	4.0	4.0		
E	TMW-W-w	MT20	2.0	4.0		
F	TS-i	MT20	3.0	6.0		
G	TMW-W-i	MT20	4.0	4.0		
H	TTWW-m	MT20	6.0	9.0	Edge	
I	TMW-W-p	MT20	5.0	6.0	1.75	2.75
K	BMV1-p	MT20	3.0	4.0		
L	BMW-W-i	MT20	4.0	9.0		
M	BMW-W-i	MT20	5.0	6.0		
N	BS-i	MT20	4.0	6.0		
O	BMW-W-i	MT20	4.0	9.0		
P	BS-i	MT20	4.0	6.0		
Q	BMW-W-i	MT20	5.0	6.0		
R	BMW-W-i	MT20	4.0	9.0		
S	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
S	2065	0	2065	0	0	5-8	5-8	5-8	5-8
K	2065	0	2065	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	0 / 0
K	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED HORZ. LOAD (LBS)	MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED HORZ. LOAD (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	R-C	-243 / 10
B-C	-2297 / 0	-91.8	-91.8	0.70 (1)	3.78	C-Q	0 / 1689
C-D	-3213 / 0	-91.8	-91.8	0.60 (1)	3.19	Q-D	-929 / 0
D-E	-3594 / 0	-91.8	-91.8	0.66 (1)	2.97	D-O	0 / 469
E-F	-3594 / 0	-91.8	-91.8	0.66 (1)	2.97	O-E	-505 / 0
F-G	-3594 / 0	-91.8	-91.8	0.66 (1)	2.97	G-Q	0 / 490
G-H	-3213 / 0	-91.8	-91.8	0.60 (1)	3.19	M-G	-929 / 0
H-I	-2296 / 0	-91.8	-91.8	0.70 (1)	3.78	M-H	0 / 1670
I-J	0 / 35	-91.8	-91.8	0.12 (1)	10.00	L-H	-243 / 10
S-B	-2023 / 0	0.0	0.0	0.21 (1)	5.94	B-R	0 / 1943
K-I	-2023 / 0	0.0	0.0	0.21 (1)	5.94	L-I	0 / 1943
S-R	0 / 0	-18.5	-18.5	0.15 (4)	10.00		
R-Q	0 / 1904	-18.5	-18.5	0.39 (1)	10.00		
Q-P	0 / 3213	-18.5	-18.5	0.58 (1)	10.00		
P-O	0 / 3213	-18.5	-18.5	0.58 (1)	10.00		
O-N	0 / 3213	-18.5	-18.5	0.58 (1)	10.00		
N-M	0 / 3213	-18.5	-18.5	0.58 (1)	10.00		
M-L	0 / 1903	-18.5	-18.5	0.39 (1)	10.00		
L-K	0 / 0	-18.5	-18.5	0.15 (4)	10.00		

TOTAL WEIGHT = 2 X 140 = 280 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.21")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.39")

OSI: TC=0.88/1.00 (E-G:1), BC=0.58/1.00 (O-Q:1),
WB=0.44/1.00 (B-R:1), SS=0.28/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PL) (PU)
MAX MIN MAX MIN
MT20 618 354 1667 789 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (B) (INPUT = 0.90)
JSI METAL = 0.74 (P) (INPUT = 1.00)




Structural component only
DWG# T-2007147

JOB NAME 408169	TRUSS NAME T22	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:49:27 2020 Page 1
ID:K?TPdngjDnptlqYdbWIOFzideG-6jO?JbugKnairecCH5ZgyXDemJ?DB9HS2Wpx??zNBDC

Scale = 1:27.3

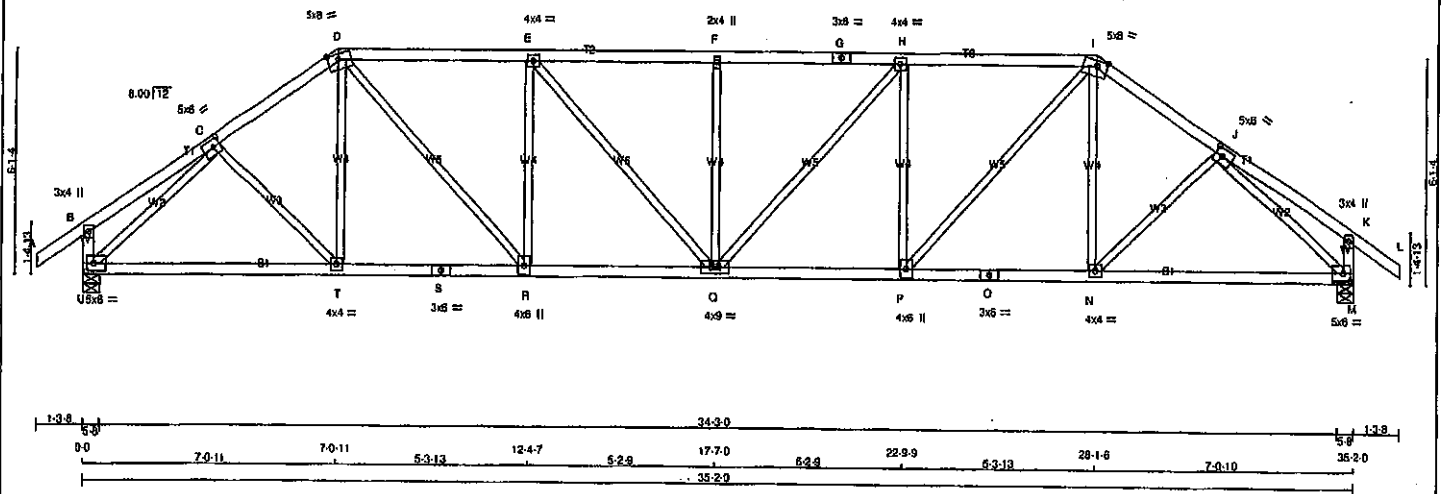

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4 DRY	No.2	SPF
D - G	2x4 DRY	No.2	SPF
G - I	2x4 DRY	No.2	SPF
I - L	2x4 DRY	No.2	SPF
U - B	2x4 DRY	No.2	SPF
M - K	2x4 DRY	No.2	SPF
U - S	2x4 DRY	No.2	SPF
S - O	2x4 DRY	No.2	SPF
O - M	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
C	TMVW-I	MT20	5.0	6.0 2.50 2.50
D	TTWW-m	MT20	5.0	8.0 1.75 3.50
E	TMVW-I	MT20	4.0	4.0
F	TMVW-w	MT20	2.0	4.0
G	TS-I	MT20	3.0	6.0
H	TMVW-I	MT20	4.0	4.0
I	TTWW-m	MT20	5.0	8.0 1.75 3.50
J	TMVW-I	MT20	5.0	6.0 2.50 2.50
K	TMV+p	MT20	3.0	4.0
M	BMVW-I	MT20	5.0	6.0 2.50 2.25
N	BMVW-I	MT20	4.0	4.0
O	BS-I	MT20	3.0	6.0
P	BMVW-w	MT20	4.0	6.0
Q	BMVW-w	MT20	4.0	6.0
R	BMVW-w	MT20	4.0	6.0
S	BS-I	MT20	3.0	6.0
T	BMVW-I	MT20	4.0	4.0
U	BMVW-I	MT20	5.0	6.0 2.50 2.25

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
GROSS REACTION		GROSS REACTION		BRG		IN-SX	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
U	2065	0	2065	0	0	5-8	5-8
M	2065	0	2065	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	COMBINED	SOIL
U	1458	970/0	0/0	0/0	0/0	489/0	0/0	1458	970/0
M	1458	970/0	0/0	0/0	0/0	489/0	0/0	1458	970/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.53 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		W E B S		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	UNBRACED LENGTH	MEMB.	FORCE (LBS)	MAX (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0/35	-91.8	-91.8 0.12 (1)	10.00	C-T	0/135	0.03 (4)
B-C	0/18	-91.8	-91.8 0.16 (1)	10.00	T-D	0/90	0.03 (4)
C-D	-2305/0	-91.8	-91.8 0.23 (1)	4.31	D-R	0/1218	0.27 (1)
D-E	-2723/0	-91.8	-91.8 0.54 (1)	3.69	E-Q	-814/0	0.48 (1)
E-F	-2988/0	-91.8	-91.8 0.56 (1)	3.53	Q-H	0/383	0.08 (1)
F-G	-2988/0	-91.8	-91.8 0.58 (1)	3.53	Q-F	-440/0	0.26 (1)
G-H	-2988/0	-91.8	-91.8 0.66 (1)	3.53	H-I	0/383	0.08 (1)
H-I	-2723/0	-91.8	-91.8 0.54 (1)	3.69	P-H	-814/0	0.48 (1)
I-J	-2305/0	-91.8	-91.8 0.23 (1)	4.31	P-I	0/1218	0.27 (1)
J-K	0/18	-91.8	-91.8 0.16 (1)	10.00	N-I	0/90	0.03 (4)
K-L	0/35	-91.8	-91.8 0.12 (1)	10.00	N-J	0/138	0.03 (4)
U-B	-255/0	0.0	0.0 0.03 (1)	7.81	U-C	-2515/0	0.97 (1)
M-K	-255/0	0.0	0.0 0.03 (1)	7.81	J-M	-2514/0	0.97 (1)
U-T	0/1802	-18.5	-18.5 0.40 (1)	10.00			
T-S	0/1901	-18.5	-18.5 0.41 (1)	10.00			
S-R	0/1901	-18.5	-18.5 0.41 (1)	10.00			
R-O	0/2724	-18.5	-18.5 0.49 (1)	10.00			
Q-P	0/2723	-18.5	-18.5 0.49 (1)	10.00			
P-O	0/1900	-18.5	-18.5 0.41 (1)	10.00			
O-N	0/1900	-18.5	-18.5 0.41 (1)	10.00			
N-M	0/1801	-18.5	-18.5 0.40 (1)	10.00			

TOTAL WEIGHT = 2 X 151 = 303 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = 1/999 (0.18)
ALLOWABLE DEFL.(TL) = L/360 (1.17)
CALCULATED VERT. DEFL.(TL) = 1/999 (0.28)

CSI: TC=0.68/1.00 (E-F-I), BC=0.49/1.00 (G-H-I),
WB=0.97/1.00 (C-U-I), SS=0.23/1.00 (H-I-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1067 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.90 (M) (INPUT = 0.90)
JSI METAL=0.63 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007148

JOB NAME 408169	TRUSS NAME T24	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamareck Roof Truss, Burlington				Version 8.310 S Oct 25 2019 Mitek Industries, Inc. Sat Apr 25 12:49:29 2020 Page 1 ID:K7TPdHgJOnp1qYdbWfOfZdeG-35WmkHwvsOqC4ymbOWc81yW7xfBtWq23uzNBDa	

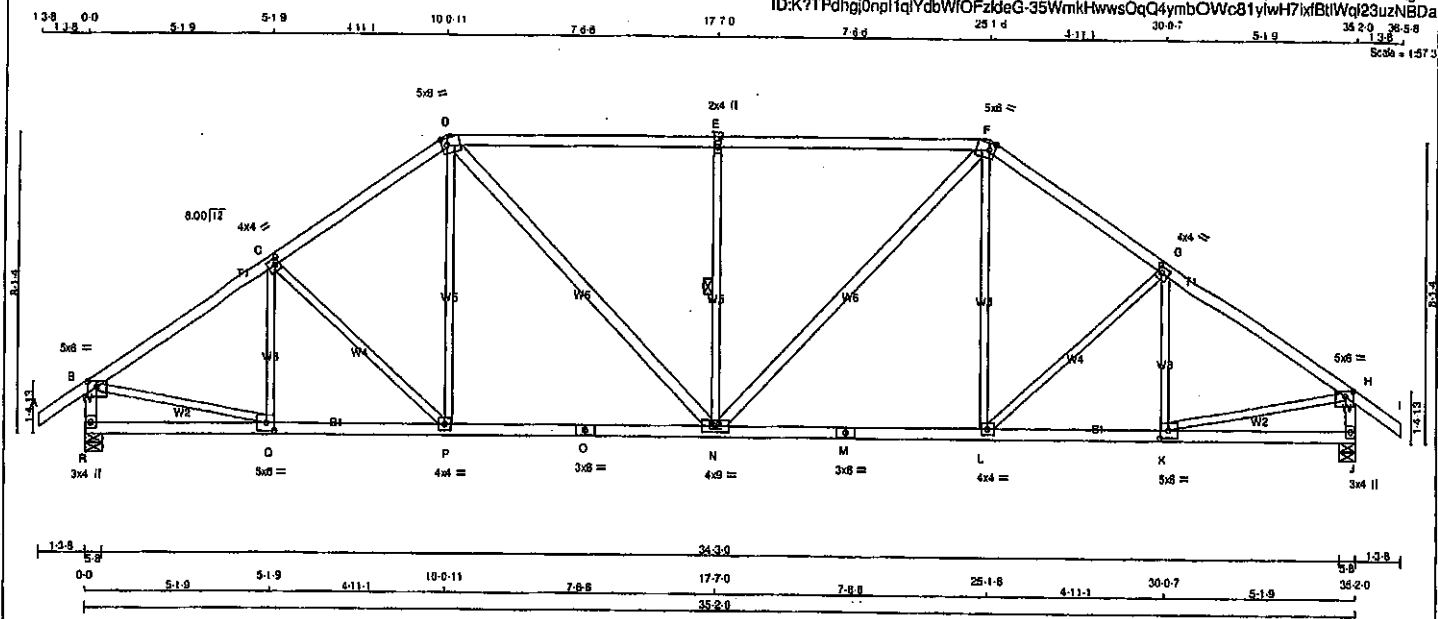

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
R - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMWW-p	MT20	5.0	8.0	1.75 2.75
C	TMWW-i	MT20	4.0	4.0	2.00 1.50
D	TTWW-m	MT20	5.0	6.0	2.25 1.75
E	TMWW-w	MT20	2.0	4.0	
F	TTWW-m	MT20	5.0	6.0	2.25 1.75
G	TMWW-i	MT20	4.0	4.0	2.00 1.50
H	TMWW-p	MT20	5.0	6.0	1.75 2.75
J	BMV-i-p	MT20	3.0	4.0	
K	BMWW-i	MT20	5.0	6.0	2.50 2.75
L	BMWW-i	MT20	4.0	4.0	
M	BS-i	MT20	3.0	6.0	
N	BMWW-i	MT20	4.0	9.0	
O	BS-i	MT20	3.0	6.0	
P	BMWW-i	MT20	4.0	4.0	
Q	BMWW-i	MT20	5.0	6.0	2.50 2.75
R	BMV-i-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
R	2065	0	0	2065	0	0	5-8	5-8	5-8
J	2065	0	0	2065	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1458	970/0	0/0	0/0	0/0	488/0	0/0
J	1458	970/0	0/0	0/0	0/0	488/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (CSI/LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (CSI/LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0/35	-91.8	-91.8 0.12 (1)	10.00	Q-C	-321/0	0.11 (1)
B-C	-2318/0	-91.8	-91.8 0.38 (1)	4.16	C-P	-218/0	0.18 (1)
C-D	-2188/0	-91.8	-91.8 0.37 (1)	4.28	P-D	0/206	0.08 (1)
D-E	-2274/0	-91.8	-91.8 0.81 (1)	3.47	D-N	0/691	0.11 (1)
E-F	-2274/0	-91.8	-91.8 0.81 (1)	3.47	N-E	-851/0	0.35 (1)
F-G	-2185/0	-91.8	-91.8 0.37 (1)	4.28	N-F	0/691	0.11 (1)
G-H	-2317/0	-91.8	-91.8 0.38 (1)	4.16	L-F	0/268	0.08 (1)
H-I	0/35	-91.8	-91.8 0.12 (1)	10.00	L-G	-218/0	0.18 (1)
R-B	-2022/0	0.0	0.0 0.21 (1)	5.94	K-G	-321/0	0.11 (1)
J-H	-2022/0	0.0	0.0 0.21 (1)	5.94	B-Q	0/1996	0.45 (1)
R-Q	0/0	-18.5	-18.5 0.10 (4)	10.00	K-H	0/1995	0.45 (1)
Q-P	0/1963	-18.5	-18.5 0.40 (1)	10.00			
P-O	0/1794	-18.5	-18.5 0.41 (1)	10.00			
O-N	0/1794	-18.5	-18.5 0.41 (1)	10.00			
N-M	0/1794	-18.5	-18.5 0.41 (1)	10.00			
M-L	0/1794	-18.5	-18.5 0.41 (1)	10.00			
L-K	0/1953	-18.5	-18.5 0.40 (1)	10.00			
K-J	0/0	-18.5	-18.5 0.10 (4)	10.00			

TOTAL WEIGHT = 2 X 158 = 317 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN. LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSI: TC=0.81/1.00 (D-E:1), BC=0.41/1.00 (N-P:1), WB=0.45/1.00 (B-Q:1), SS=0.34/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (B) (INPUT = 0.90)
JSI METAL= 0.84 (M) (INPUT = 1.00)




Structural component only
DWG# T-2007150

JOB NAME 408169	TRUSS NAME T25	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Milltek Industries, Inc. Sat Apr 25 12:49:30 2020 Page 1
ID:K?TPdhgJ0np1qYdbWIOFzIdaG-XI48xdwYdlyHl6LnyE7Na9q9dX2TOe3ukU2bbKzNBDZ

1:2.8 0.0 5-10.9 5-10.9 5-9.1 11-5-11 6-0.6 17-7.0 6-0.6 23-7.6 5-9.1 29-3-7 5-10.9 35-2-0 36-5-8 1:3.6
Scale = 1:57.3

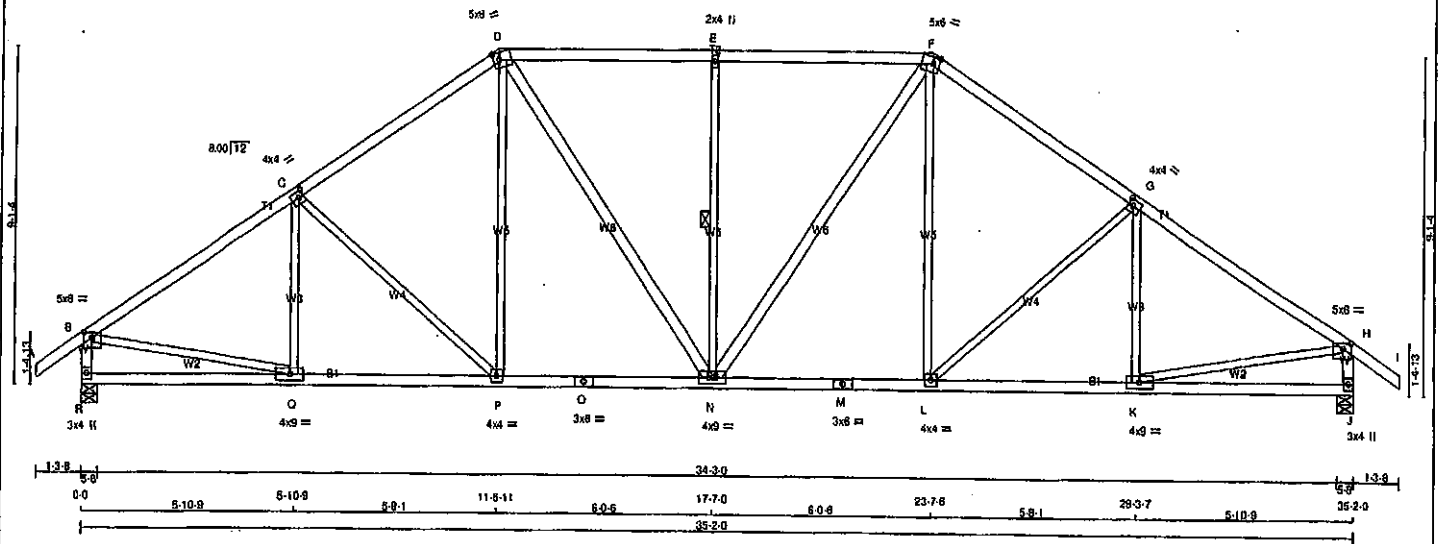

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMWV-p	MT20	5.0	8.0	1.75 2.75
C	TMWV-l	MT20	4.0	4.0	2.00 1.50
D	TTWV-m	MT20	5.0	6.0	2.25 2.00
E	TMW-w	MT20	2.0	4.0	
F	TTWV-m	MT20	5.0	8.0	2.25 2.00
G	TMWV-l	MT20	4.0	4.0	2.00 1.50
H	TMWV-p	MT20	5.0	8.0	1.75 2.75
J	BMV1-p	MT20	3.0	4.0	
K	BMWV-l	MT20	4.0	9.0	
L	BMWV-l	MT20	4.0	4.0	
M	BS-l	MT20	3.0	8.0	
N	BMVWV-l	MT20	4.0	9.0	
O	BS-l	MT20	3.0	8.0	
P	BMWV-l	MT20	4.0	4.0	
Q	BMWV-l	MT20	4.0	9.0	
R	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT VERT	HORZ	DOWN	HORZ	IN-SX		IN-SX	
R 2065	0	2065	0	5-8		5-8	
J 2065	0	2065	0	5-8		5-8	

UNFACTORED REACTIONS							
1ST CASE MAX/MIN COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
J	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0 / 35	-91.8 -91.8	0.12 (1)	10.00	Q-G	-248 / 11	0.11 (1)
B-C	-2347 / 0	-91.8 -91.8	0.52 (1)	3.99	C-P	-356 / 0	0.42 (1)
C-D	-2096 / 0	-91.8 -91.8	0.48 (1)	4.22	P-D	0 / 342	0.08 (1)
D-E	-1985 / 0	-91.8 -91.8	0.49 (1)	4.26	D-N	0 / 477	0.08 (1)
E-F	-1985 / 0	-91.8 -91.8	0.49 (1)	4.26	N-E	-677 / 0	0.37 (1)
F-G	-2095 / 0	-91.8 -91.8	0.48 (1)	4.22	N-F	0 / 477	0.08 (1)
G-H	-2346 / 0	-91.8 -91.8	0.52 (1)	3.99	L-F	0 / 341	0.08 (1)
H-I	0 / 35	-91.8 -91.8	0.12 (1)	10.00	L-G	-358 / 0	0.42 (1)
R-B	-2019 / 0	0.0 0.0	0.21 (1)	5.94	K-G	-249 / 11	0.11 (1)
J-H	-2019 / 0	0.0 0.0	0.21 (1)	5.94	B-Q	0 / 2014	0.45 (1)
					K-H	0 / 2014	0.45 (1)
R-Q	0 / 0	-18.5 -18.5	0.14 (4)	10.00			
Q-P	0 / 1991	-18.5 -18.5	0.39 (1)	10.00			
P-O	0 / 1716	-18.5 -18.5	0.34 (1)	10.00			
O-N	0 / 1716	-18.5 -18.5	0.34 (1)	10.00			
N-M	0 / 1716	-18.5 -18.5	0.34 (1)	10.00			
M-L	0 / 1716	-18.5 -18.5	0.34 (1)	10.00			
L-K	0 / 1980	-18.5 -18.5	0.39 (1)	10.00			
K-J	0 / 0	-18.5 -18.5	0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 8 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17')
CALCULATED VERT. DEFL. (LL) = L/999 (0.10')
ALLOWABLE DEFL. (TL) = L/360 (1.17')
CALCULATED VERT. DEFL. (TL) = L/999 (0.19')

CSI: TC=0.52/1.00 (B-C:1), BC=0.39/1.00 (P-Q:1), WB=0.45/1.00 (B-Q:1), SS=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (B) (INPUT = 0.80)
JSI METAL= 0.58 (M) (INPUT = 1.00)




Structural component only
DWG# T-2007151

JOB NAME	TRUSS NAME	QUANTITY	PLV	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408169	T26	5	1	TRUSS DESC.		

Tamrack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 12:49:32 2020 Page 1

ID:K?TPdhgi0npl1qIYdbWlOFzIdG-TgCuMjyo8JC?yPVA3e9fawTUK(TsYXBCoXigDzNBDX

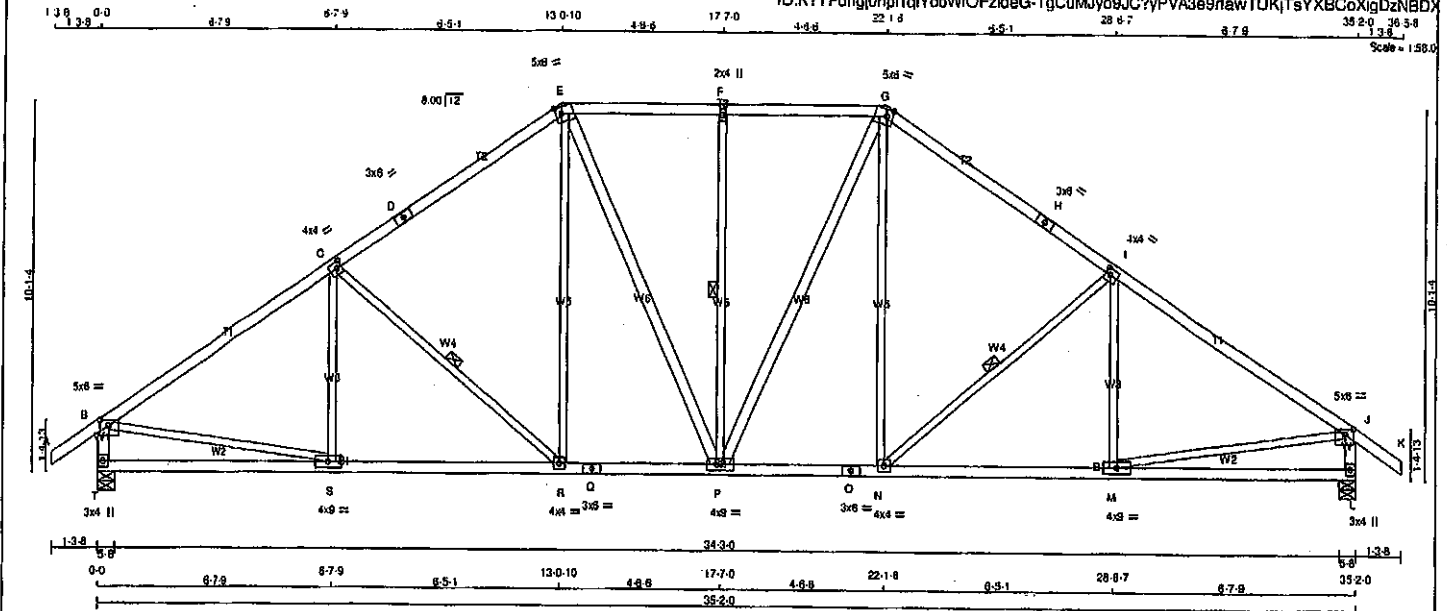

TOTAL WEIGHT = 5 X 172 = 858 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2		
D - E	2x4	DRY	No.2		
E - F	2x4	DRY	No.2		
F - G	2x4	DRY	No.2		
G - H	2x4	DRY	No.2		
H - I	2x4	DRY	No.2		
I - J	2x4	DRY	No.2		
J - K	2x4	DRY	No.2		
K - L	2x4	DRY	No.2		
ALL WEBS	2x3	DRY	No.2		
EXCEPT	2x4	DRY	No.2		
E - P	2x4	DRY	No.2		
P - G	2x4	DRY	No.2		

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	IN-SX	IN-SX
T	2065	0	5-8	5-8
L	2065	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
T	1455	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0
L	1455	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-R, F-P, I-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS

MEMB. MAX. FACTORED FORCE (LBS)

FACTORED VERT. LOAD (PLF)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

MAX. FACTORED VERT. LOAD (LBS)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, NBCC 2015

- PART 9 OF NBCC 2012 (2019 AMENDMENT)

- CSA 088-08, CSA 086-14

- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')

CALCULATED VERT. DEFL.(LL) = L/399 (0.09')

ALLOWABLE DEFL.(TL) = L/360 (1.17')

CALCULATED VERT. DEFL.(TL) = L/399 (0.18')

CSI: TC=0.69/1.00 (B-C:1), BC=0.42/1.00 (R-S:1), WB=0.45/1.00 (B-S:1), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 618 354 1667 789 1987 1668

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.87 (B) (INPUT = 0.90)

JSI METAL= 0.50 (C) (INPUT = 1.00)

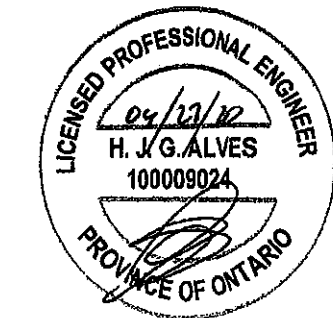

Structural component only
DWG# T-2007152

JOB NAME 408169	TRUSS NAME T27	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

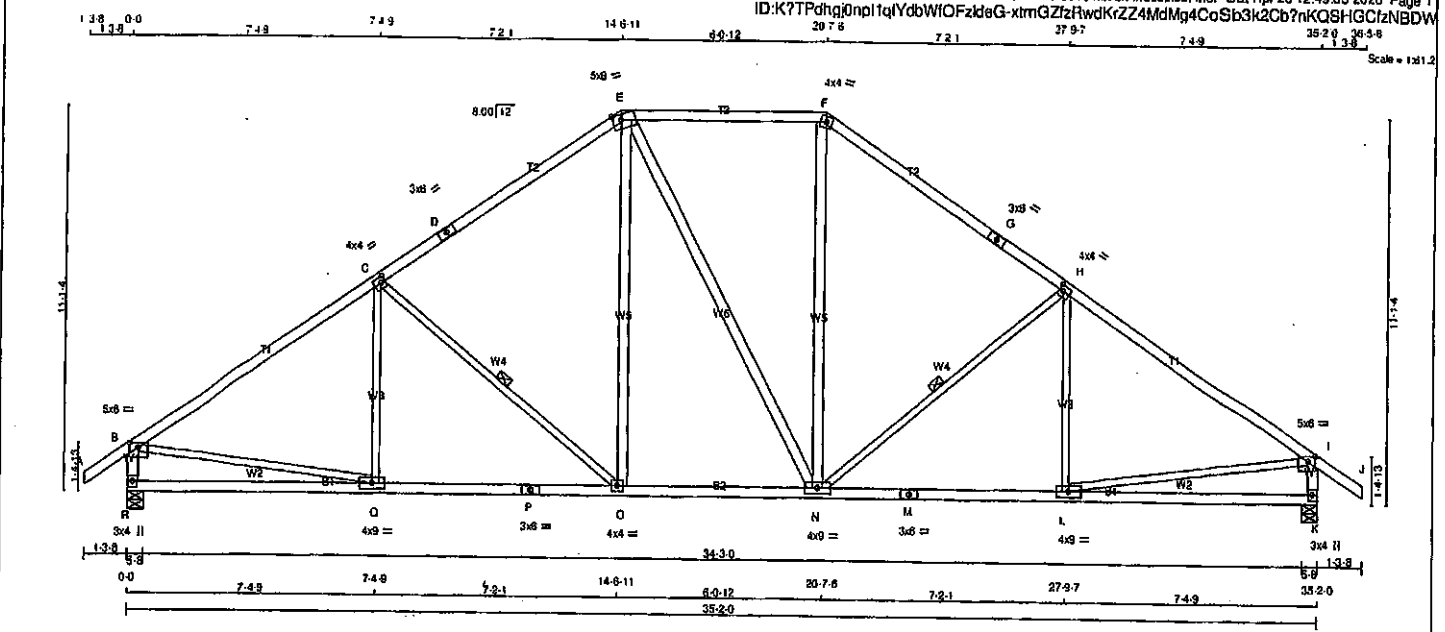

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
R - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2
M - K	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
O - E	2x4	DRY	No.2
E - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0	6.0 1.75 2.75
C	TMVW-1	MT20	4.0	4.0 2.00 1.50
D	TS-1	MT20	3.0	6.0
F	TTW-m	MT20	5.0	6.0 2.00 3.00
G	TS-1	MT20	3.0	6.0
H	TMVW-1	MT20	4.0	4.0 2.00 1.50
I	TMVW-p	MT20	5.0	6.0 1.75 2.75
K	BMV1-p	MT20	3.0	4.0
L	BMVW-1	MT20	4.0	6.0
M	BS-1	MT20	3.0	6.0
N	BMVW-1	MT20	4.0	6.0
O	BMVW-1	MT20	4.0	6.0
R	BMV1-p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
GROSS REACTION	BRG	GROSS REACTION	BRG	IN-SX	IN-SX	IN-SX	IN-SX
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
R	2065	0	2065	0	0	5-8	5-8
K	2065	0	2065	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	DEAD	SOIL
R	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	488 / 0	0 / 0
K	1458	970 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.45 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	FORCE (LBS)	MAX. CS (LC)	MAX. CS (LC)
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	Q-C	-139 / 76	0.09 (1)
B-C	-2358 / 0	-91.8	-91.8 0.89 (1)	3.45	C-O	-605 / 0	0.38 (1)
C-D	-1808 / 0	-91.8	-91.8 0.78 (1)	3.91	O-E	0 / 499	0.08 (1)
D-E	-1808 / 0	-91.8	-91.8 0.78 (1)	3.91	E-N	0 / 0	0.00 (1)
E-F	-1538 / 0	-91.8	-91.8 0.47 (1)	4.74	N-F	0 / 500	0.08 (1)
F-G	-1808 / 0	-91.8	-91.8 0.78 (1)	3.91	N-H	-604 / 0	0.38 (1)
G-H	-1808 / 0	-91.8	-91.8 0.78 (1)	3.91	L-H	-140 / 75	0.09 (1)
H-I	-2357 / 0	-91.8	-91.8 0.89 (1)	3.45	B-Q	0 / 2020	0.45 (1)
I-J	0 / 35	-91.8	-91.8 0.12 (1)	10.00	L-I	0 / 2019	0.45 (1)
R-B	-2009 / 0	0.0	0.0 0.21 (1)	5.85			
K-I	-2009 / 0	0.0	0.0 0.21 (1)	5.85			
R-Q	0 / 0	-18.5	-18.5 0.26 (4)	10.00			
Q-P	0 / 1999	-18.5	-18.5 0.45 (1)	10.00			
P-O	0 / 1999	-18.5	-18.5 0.45 (1)	10.00			
O-N	0 / 1538	-18.5	-18.5 0.33 (1)	10.00			
N-M	0 / 1998	-18.5	-18.5 0.45 (1)	10.00			
M-L	0 / 1998	-18.5	-18.5 0.45 (1)	10.00			
L-K	0 / 0	-18.5	-18.5 0.24 (4)	10.00			

TOTAL WEIGHT = 2 X 168 = 336 (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.17")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.09")
ALLOWABLE DEFL.(TL) = $L/360$ (1.17")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.20")

CSI: TC=0.89/1.00 (B-C:1), BC=0.45/1.00 (C-Q:1),
WB=0.45/1.00 (B-Q:1), SSI=0.27/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.90 (F) (INPUT = 0.90)
JSI METAL= 0.88 (P) (INPUT = 1.00)



Structural component only
DWG# T-2007153

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T28	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 26 12:49:34 2020 Page 1
ID:K7TPdhgi0npl1qYdbWIOFzKdeG-P3Jn7_3gwSIBjYB3BJk7?uz8RBKVILU60p15zNBDV

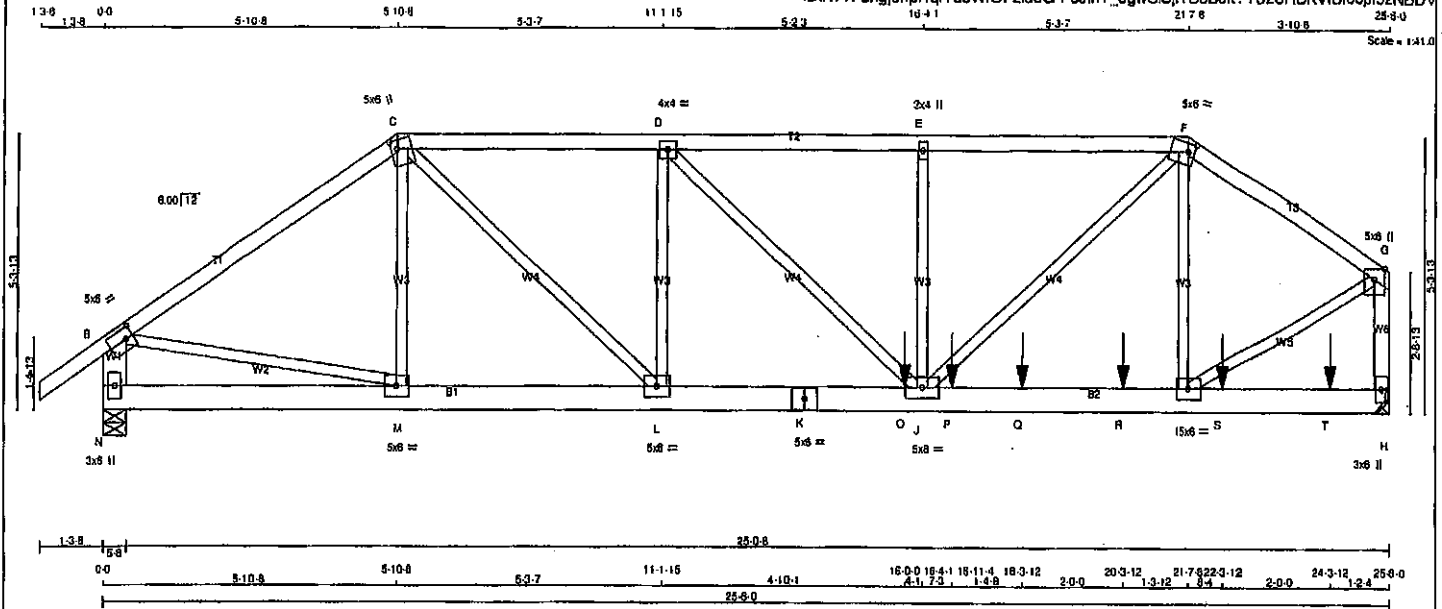

TOTAL WEIGHT = 2 X 122 = 245 lb

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
N - B	2x6	DRY	No.2
H - G	2x4	DRY	No.2
N - K	2x6	DRY	No.2
K - H	2x6	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
C - F	12	TOP
F - G	12	TOP
H - G	12	TOP
N - B	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
N - K	12	TOP
K - H	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
E - J	6	SIDE(163.1)
2x3	6	SIDE(77.0)

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	UPLIFT	IN-SX
N	2086	0	0	5-8
H	2756	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

1ST CASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED
N	1470
H	1941

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

SHACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.76 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)		
FR-TO		FROM	TO		FR-TO				
A-B	0 / 35	-91.8	-91.8	0.07 (1)	10.00	M-C	-218 / 22	0.04 (1)	
B-C	-2383 / 0	-91.8	-91.8	0.37 (1)	5.41	C-L	0 / 1550	0.19 (1)	
C-D	-3083 / 0	-91.8	-91.8	0.24 (1)	5.03	L-D	-928 / 0	0.19 (1)	
D-E	-3519 / 0	-91.8	-91.8	0.25 (1)	4.70	D-J	0 / 509	0.07 (1)	
E-F	-3519 / 0	-91.8	-91.8	0.24 (1)	4.79	J-E	-508 / 0	0.10 (1)	
F-G	-3352 / 0	-91.8	-91.8	0.18 (1)	5.69	J-F	0 / 2156	0.27 (1)	
N-B	-2037 / 0	0.0	0.0	0.07 (1)	7.81	I-F	-548 / 0	0.11 (1)	
H-G	-2632 / 0	0.0	0.0	0.19 (1)	7.01	B-M	0 / 1991	0.25 (1)	
						I-G	0 / 2264	0.28 (1)	
N-M	0 / 0	-18.5	-18.5	0.04 (4)	10.00				
M-L	0 / 1959	-18.5	-18.5	0.14 (1)	10.00				
L-K	0 / 3093	-18.5	-18.5	0.27 (1)	10.00				
K-O	0 / 3093	-18.5	-18.5	0.27 (1)	10.00				
O-J	0 / 3093	-18.5	-18.5	0.27 (1)	10.00				
J-P	0 / 1942	-18.5	-18.5	0.23 (1)	10.00				
P-Q	0 / 1942	-18.5	-18.5	0.23 (1)	10.00				
Q-R	0 / 1942	-18.5	-18.5	0.23 (1)	10.00				
R-I	0 / 1942	-18.5	-18.5	0.23 (1)	10.00				
I-S	0 / 0	-18.5	-18.5	0.10 (1)	10.00				
S-T	0 / 0	-18.5	-18.5	0.10 (1)	10.00				
T-H	0 / 0	-18.5	-18.5	0.10 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
JT	16-0-0	-997	-997	---	FRONT	VERT	TOTAL	---	C1
P	16-11-4	-187	-187	---	FRONT	VERT	TOTAL	---	C1
Q	18-3-12	-187	-187	---	FRONT	VERT	TOTAL	---	C1
R	20-3-12	-187	-187	---	FRONT	VERT	TOTAL	---	C1
S	22-3-12	-174	-174	---	FRONT	VERT	TOTAL	---	C1
T	24-3-12	-173	-173	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.85")
CALCULATED VERT. DEFL.(LL) = L/989 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.85")
CALCULATED VERT. DEFL.(TL) = L/989 (0.11")

GS: TC=0.37/1.00 (B-C:1), BC=0.27/1.00 (J-L:1), WB=0.28/1.00 (G-I:1), SS=0.34/1.00 (J-L:1)

COL LUMBER=1.00 NAIL=1.00 LB SEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1857 788 1887 1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (F) (INPUT = 0.90)
JSI METAL= 0.45 (G) (INPUT = 1.00)




Structural component only
DWG# T-2007154 1/2

CONTINUED ON PAGE 2

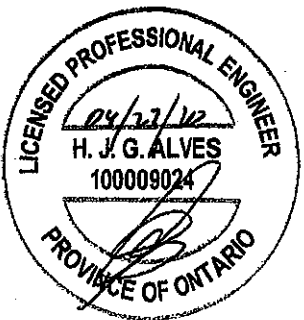JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.																																																																																																		
408169	T28	1	2	GREEN PARK HOMES																																																																																																			
Tamarack Roof Truss, Burlington																																																																																																							
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:34 2020 Page 2 ID:K?TPdhiQnpl1qYdbWlQFzIdG-P3Jln?_3qwSiBIYB3Bjk??uz8RBKVIUf6Qol5zN8DV																																																																																																							
<table border="1"><thead><tr><th colspan="7">PLATES (table is in inches)</th></tr><tr><th>JT</th><th>TYPE</th><th>PLATES</th><th>W</th><th>LEN</th><th>Y</th><th>X</th></tr></thead><tbody><tr><td>B</td><td>TMVW-l</td><td>MT20</td><td>5.0</td><td>6.0</td><td>2.50</td><td>1.75</td></tr><tr><td>C</td><td>TTWW+m</td><td>MT20</td><td>5.0</td><td>6.0</td><td>2.00</td><td>1.50</td></tr><tr><td>D</td><td>TMVW-l</td><td>MT20</td><td>4.0</td><td>4.0</td><td></td><td></td></tr><tr><td>E</td><td>TMVW+w</td><td>MT20</td><td>2.0</td><td>4.0</td><td></td><td></td></tr><tr><td>F</td><td>TTWW-m</td><td>MT20</td><td>5.0</td><td>6.0</td><td>2.00</td><td>1.50</td></tr><tr><td>G</td><td>TMVW+p</td><td>MT20</td><td>5.0</td><td>6.0</td><td>Edge</td><td></td></tr><tr><td>H</td><td>BMV1+p</td><td>MT20</td><td>3.0</td><td>6.0</td><td></td><td></td></tr><tr><td>I, L, M</td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>I</td><td>BMVW-l</td><td>MT20</td><td>5.0</td><td>6.0</td><td></td><td></td></tr><tr><td>J</td><td>BMVW-l</td><td>MT20</td><td>5.0</td><td>6.0</td><td></td><td></td></tr><tr><td>K</td><td>BS-l</td><td>MT20</td><td>5.0</td><td>6.0</td><td></td><td></td></tr><tr><td>N</td><td>BMV1+p</td><td>MT20</td><td>3.0</td><td>6.0</td><td></td><td></td></tr></tbody></table> Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.						PLATES (table is in inches)							JT	TYPE	PLATES	W	LEN	Y	X	B	TMVW-l	MT20	5.0	6.0	2.50	1.75	C	TTWW+m	MT20	5.0	6.0	2.00	1.50	D	TMVW-l	MT20	4.0	4.0			E	TMVW+w	MT20	2.0	4.0			F	TTWW-m	MT20	5.0	6.0	2.00	1.50	G	TMVW+p	MT20	5.0	6.0	Edge		H	BMV1+p	MT20	3.0	6.0			I, L, M							I	BMVW-l	MT20	5.0	6.0			J	BMVW-l	MT20	5.0	6.0			K	BS-l	MT20	5.0	6.0			N	BMV1+p	MT20	3.0	6.0		
PLATES (table is in inches)																																																																																																							
JT	TYPE	PLATES	W	LEN	Y	X																																																																																																	
B	TMVW-l	MT20	5.0	6.0	2.50	1.75																																																																																																	
C	TTWW+m	MT20	5.0	6.0	2.00	1.50																																																																																																	
D	TMVW-l	MT20	4.0	4.0																																																																																																			
E	TMVW+w	MT20	2.0	4.0																																																																																																			
F	TTWW-m	MT20	5.0	6.0	2.00	1.50																																																																																																	
G	TMVW+p	MT20	5.0	6.0	Edge																																																																																																		
H	BMV1+p	MT20	3.0	6.0																																																																																																			
I, L, M																																																																																																							
I	BMVW-l	MT20	5.0	6.0																																																																																																			
J	BMVW-l	MT20	5.0	6.0																																																																																																			
K	BS-l	MT20	5.0	6.0																																																																																																			
N	BMV1+p	MT20	3.0	6.0																																																																																																			
 Structural component only DWG# T-2007154																																																																																																							

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T29	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. 3a) Apr 25 12:49:35 2020 Page 1
ID:K?TPdghj0npl1qYdbWOFzIdeG-IFt1_L_hREaZpDkinYHDY1dYm23pNduumMHYzNBDU

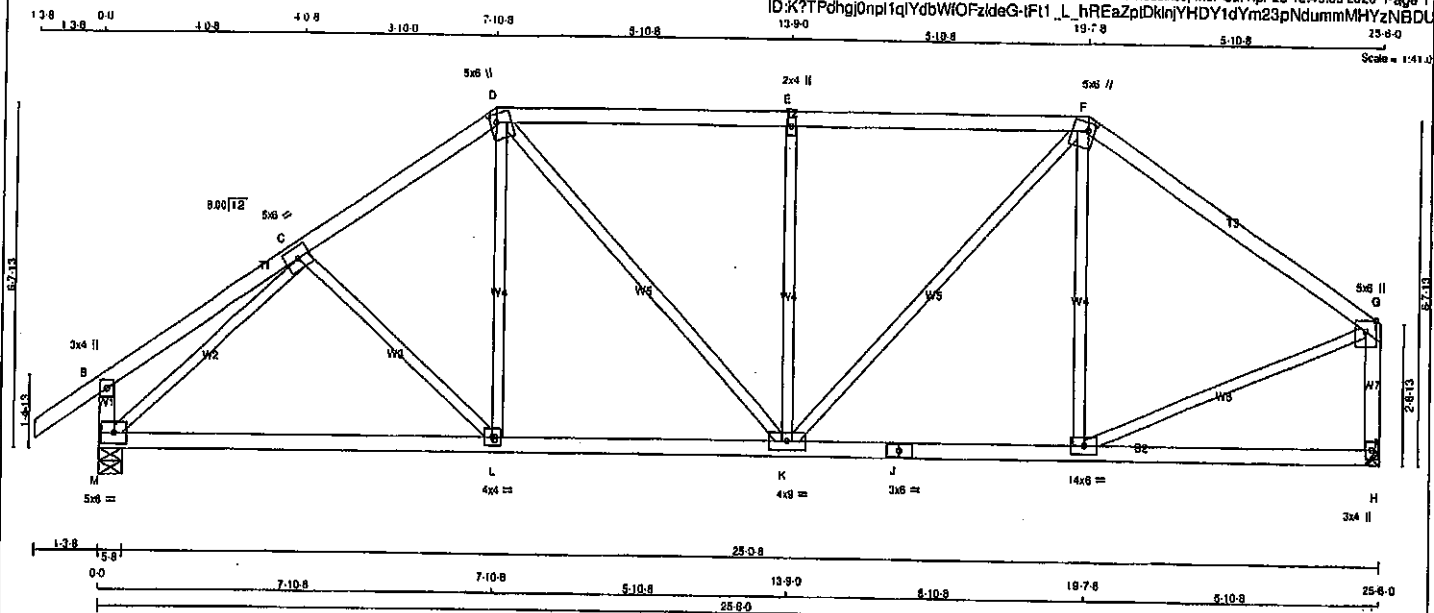

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
M - B	2x4	DRY	No.2
H - G	2x4	DRY	No.2
M - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
C	TMWW-I	MT20	5.0	6.0
D	TTWW+m	MT20	5.0	6.0 2.00 1.50
E	TMV+w	MT20	2.0	4.0
F	TTWW+m	MT20	5.0	6.0 2.00 1.50
G	TMV+p	MT20	5.0	6.0 Edge
H	BMV1+p	MT20	3.0	4.0
I	BMWW-I	MT20	4.0	6.0
J	BS-I	MT20	3.0	6.0
K	BMWW-I	MT20	4.0	6.0
L	BMWW-I	MT20	4.0	6.0
M	BMV1-I	MT20	5.0	6.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT HORZ	DOWN HORZ UPLIFT	IN-SX	IN-SX
M 1532 0	1532 0	5-8	5-8
H 1408 0	1408 0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
M 1081	723 / 0
H 994	652 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.89 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS (LC)
FR-TO	FROM TO	LENGTH	FR-TO
A-B	0 / 35	-91.8 -91.8	0.12 (1)
B-C	0 / 22	-91.8 -91.8	0.22 (1)
C-D	-1481 / 0	-91.8 -91.8	0.19 (1)
D-E	-1484 / 0	-91.8 -91.8	0.44 (1)
E-F	-1484 / 0	-91.8 -91.8	0.44 (1)
F-G	-1228 / 0	-91.8 -91.8	0.44 (1)
M-B	-288 / 0	0.0 0.0	0.03 (1)
H-G	-1362 / 0	0.0 0.0	0.20 (1)
M-L	0 / 1279	-18.5 -18.5	0.36 (4)
L-K	0 / 1223	-18.5 -18.5	0.36 (4)
K-J	0 / 1014	-18.5 -18.5	0.28 (1)
J-I	0 / 1014	-18.5 -18.5	0.28 (1)
I-H	0 / 0	-18.5 -18.5	0.17 (4)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.8 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEF. (LL) = L/360 (0.85")
CALCULATED VERT. DEF. (LL) = L/999 (0.05")
ALLOWABLE DEF. (TL) = L/360 (0.85")
CALCULATED VERT. DEF. (TL) = L/999 (0.15")

CSF TC=0.44/1.00 (F-G:1), BC=0.36/1.00 (K-L:4),
WB=0.83/1.00 (C-M:1), SS=0.26/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 768

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.82 (D) (INPUT = 0.90)
JSI METAL= 0.51 (G) (INPUT = 1.00)

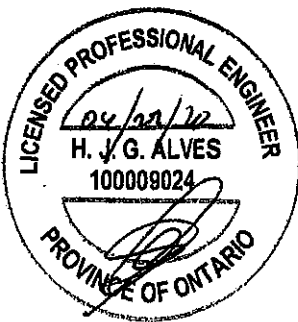


Structural component only
DWG# T-2007155

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T30	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:38 2020 Page 1
ID:K?TPdhgJOnpl1qYdbWIOFzIdeG-MSRPG7JCYIQQ10xIUEnpQ4FSy9zoKVn7QVwp_zNBDT

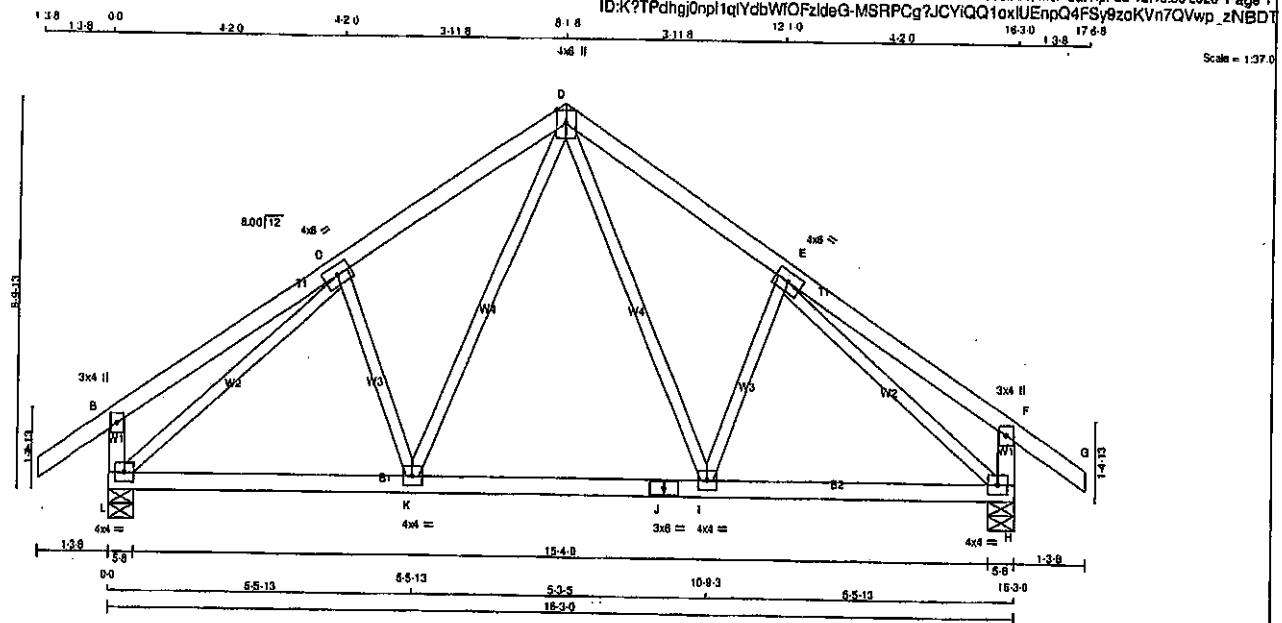

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
L - F	2x4	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-1	MT20	4.0	8.0		
D	TTWW+p	MT20	4.0	8.0	Edge	
E	TMVW-1	MT20	4.0	8.0		
F	TMV+p	MT20	3.0	4.0		
H	BMVW-1	MT20	4.0	4.0		
I	BMVW-1	MT20	4.0	4.0		
J	BS-t	MT20	3.0	8.0		
K	BMVW-1	MT20	4.0	4.0		
L	BMVW-1	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
L	1022	0	1022	0
H	1022	0	1022	0

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE
L	720	488 / 0	0 / 0	0 / 0
H	720	488 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		FACTORED	
MEMB.	FORCE	VERT. LOAD	LC1 MAX	MAX. UNBRAC	MEMB.	FORCE	MAX
	(LBS)	(PLF)	CSI (LC)	LENGTH		(LBS)	CSI (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	D-I	0 / 338	0.08 (1)
B-C	0 / 24	-91.8	-91.8 0.24 (1)	10.00	J-E	-217 / 0	0.08 (1)
C-D	-845 / 0	-91.8	-91.8 0.19 (1)	6.25	K-D	0 / 338	0.08 (1)
D-E	-845 / 0	-91.8	-91.8 0.19 (1)	6.25	C-K	-217 / 0	0.06 (1)
E-F	0 / 24	-91.8	-91.8 0.24 (1)	10.00	L-C	-1042 / 0	0.52 (1)
F-G	0 / 35	-91.8	-91.8 0.12 (1)	10.00	E-H	-1042 / 0	0.52 (1)
L-B	-288 / 0	0.0	0.0 0.03 (1)	7.81			
H-F	-288 / 0	0.0	0.0 0.03 (1)	7.81			
L-K	0 / 782	-18.5	-18.5 0.19 (1)	10.00			
K-J	0 / 557	-18.5	-18.5 0.17 (4)	10.00			
J-I	0 / 557	-18.5	-18.5 0.17 (4)	10.00			
I-H	0 / 782	-18.5	-18.5 0.19 (1)	10.00			

TOTAL WEIGHT = 2 X 72 = 145 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2018
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TFC 2011, TFC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (0.54")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.02")
ALLOWABLE DEFL.(TL) = 1/360 (0.54")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.04")

CSI: TC=0.24/1.00 (B-C:1), BC=0.19/1.00 (H-I:1),
WB=0.52/1.00 (C-L:1), SS=0.15/1.00 (G-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1897 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (H) (INPUT = 0.90)
JSI METAL= 0.29 (L) (INPUT = 1.00)




Structural component only
DWG# T-2007156

JOB NAME 408169	TRUSS NAME T30A	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Sat Apr 25 12:49:37 2020 Page 1
ID:K?TPdhgiOnp1qYdbW/OZfdeG-qe?nP00xzrqH2AN7sC0MedQCLVGXo_wL4FTLQzNBDS

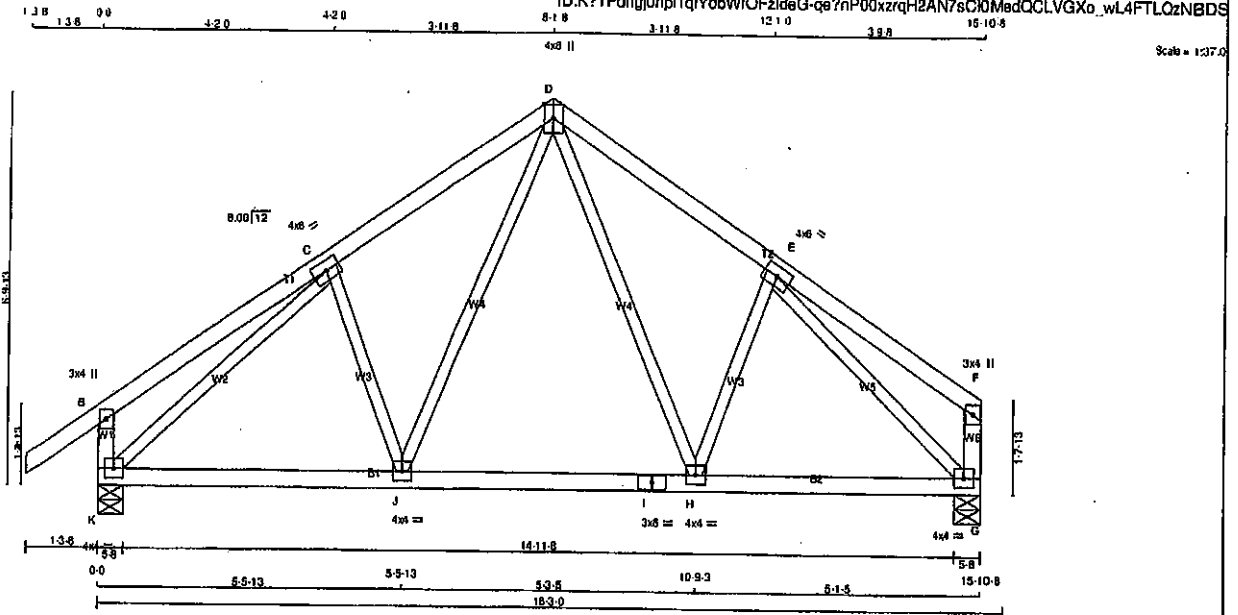

LUMBER						
N. L. G. A. RULES						
CHORDS		SIZE	LUMBER		DESCR	
A - D	2x4	DRY	No.2	SPF		
D - F	2x4	DRY	No.2	SPF		
K - 8	2x4	DRY	No.2	SPF		
G - F	2x4	DRY	No.2	SPF		
K - I	2x4	DRY	No.2	SPF		
I - G	2x4	DRY	No.2	SPF		
ALL WEBS		2x3	DRY	No.2	SPF	
EXCEPT						

EXCEPT

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	8.0		
D	TTWW+p	MT20	4.0	8.0	Edge	
E	TMWW-t	MT20	4.0	8.0		
F	TMV+p	MT20	3.0	4.0		
G	BMVW1-t	MT20	4.0	4.0		
H	BMWW-t	MT20	4.0	4.0		
I	BS-t	MT20	3.0	8.0		
J	BMWW-t	MT20	4.0	4.0		
K	BMVW1-t	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
K	1001	0	1001	0	5-8	5-8
G	875	0	875	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
K	708	478 / 0	0 / 0	0 / 0	0 / 0	229 / 0	0 / 0
G	619	408 / 0	0 / 0	0 / 0	0 / 0	213 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	D-H	0 / 272
B-C	0 / 24	-91.8	-91.8	0.24 (1)	10.00	H-E	-160 / 2
C-D	-817 / 0	-91.8	-91.8	0.19 (1)	6.25	J-D	0 / 342
D-E	-783 / 0	-91.8	-91.8	0.18 (1)	6.25	C-J	-222 / 0
E-F	0 / 24	-91.8	-91.8	0.22 (1)	10.00	K-C	-1012 / 0
K-B	-288 / 0	0.0	0.0	0.03 (1)	7.81	E-G	-982 / 0
G-F	-124 / 0	0.0	0.0	0.01 (1)	7.81		
K-J	0 / 740	-18.5	-18.5	0.18 (1)	10.00		
J-I	0 / 531	-18.5	-18.5	0.17 (4)	10.00		
I-H	0 / 531	-18.5	-18.5	0.17 (4)	10.00		
H-G	0 / 681	-18.5	-18.5	0.17 (1)	10.00		

TOTAL WEIGHT = 2 X 70 = 140 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.53")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.53")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.04")

CSK TC=0.24/1.00 (B-C:1), BC=0.18/1.00 (J-K:1), WB=0.51/1.00 (C-K:1), SS=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (K) (INPUT = 0.90)
JSI METAL = 0.28 (K) (INPUT = 1.00)




Structural component only
DWG# T-2007157

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408169	T30S	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:38 2020 Page 1
ID:K?TPdghj0npl1qYdbWOFzideG-lqZ9cm1Zk9y8gKyJQvGFvAbElmYGAw4ak_1uszNBDR

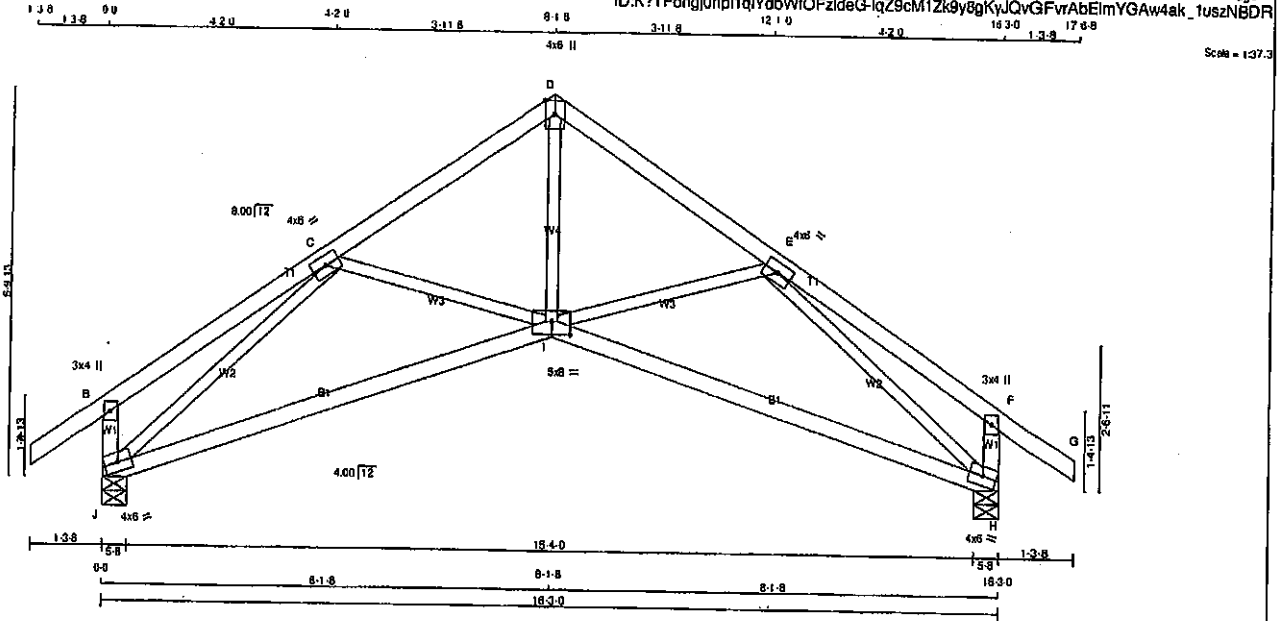

Scale = 1/32

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DESCR.
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
J - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW+1	MT20	4.0	6.0		
D	TTW+p	MT20	4.0	6.0	Edge	
E	TMVW+1	MT20	4.0	6.0		
F	TMV+p	MT20	3.0	4.0		
H	BMVW+1	MT20	4.0	6.0		
I	BMVW+1	MT20	5.0	6.0	2.75	4.00
J	BMVW+1	MT20	4.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	BRG	BRG
J	1022	0		1022	0	0	5-8	IN-SX
H	1022	0		1022	0	0	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	720	488 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0
H	720	488 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.76 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8 -91.8	0.12 (1)	I-D	0 / 942	0.21 (1)	
B-C	0 / 22	-91.8 -91.8	0.22 (1)	I-E	-143 / 11	0.05 (1)	
C-D	-1134 / 0	-91.8 -91.8	0.19 (1)	C-I	-143 / 11	0.05 (1)	
D-E	-1134 / 0	-91.8 -91.8	0.19 (1)	J-C	-1478 / 0	0.78 (1)	
E-F	0 / 22	-91.8 -91.8	0.22 (1)	E-H	-1478 / 0	0.78 (1)	
F-G	0 / 35	-91.8 -91.8	0.12 (1)				
J-B	-273 / 0	0.0 0.0	0.03 (1)				
H-F	-273 / 0	0.0 0.0	0.03 (1)				
J-I	0 / 1120	-18.5 -18.5	0.44 (4)				
I-H	0 / 1120	-18.5 -18.5	0.44 (4)				

TOTAL WEIGHT = 2 X 67 = 133 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.64)
CALCULATED VERT. DEFL.(LL) = L/999 (0.05)
ALLOWABLE DEFL.(TL) = L/360 (0.64)
CALCULATED VERT. DEFL.(TL) = L/789 (0.25)

CSI: TC=0.22/1.00 (E-F:1), BC=0.44/1.00 (H-I:4), WB=0.78/1.00 (C-J:1), SS=0.15/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MT20	618	354
	1667	788
	1987	1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (H) (INPUT = 0.90)
JSI METAL= 0.35 (H) (INPUT = 1.00)

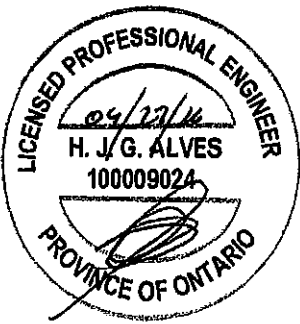


Structural component only
DWG# T-2007158

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408169	T31S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:49:39 2020 Page 1
ID:K7TPdhgJ0np11qVdbW/OFzIdaG-m17Yq1BVT4?HUXW_dnUR3InH9Cs?pxDpOkaQJzNBDC

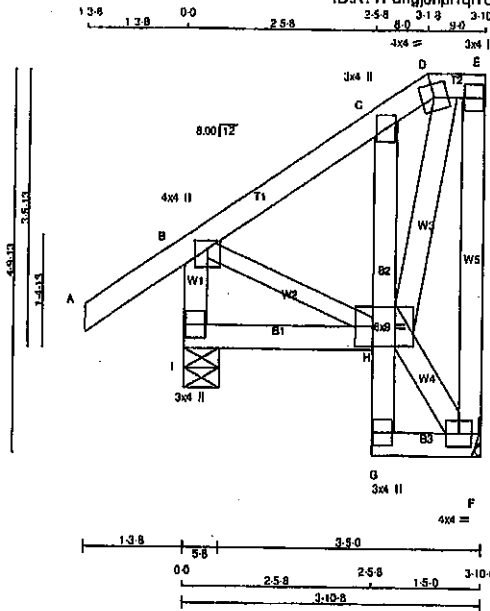

Scale = 1/258

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY No.2	SPF
D - E	2x4	DRY No.2	SPF
E - F	2x4	DRY No.2	SPF
F - G	2x4	DRY No.2	SPF
G - H	2x4	DRY No.2	SPF
H - I	2x4	DRY No.2	SPF
I - J	2x4	DRY No.2	SPF
J - K	2x4	DRY No.2	SPF
K - L	2x4	DRY No.2	SPF
L - M	2x4	DRY No.2	SPF
M - N	2x4	DRY No.2	SPF
N - O	2x4	DRY No.2	SPF
O - P	2x4	DRY No.2	SPF
P - Q	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x4	DRY No.2	SPF
B - H	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (tablets in inches)			
JT TYPE	PLATES	W	LEN Y X
B	TMVW+p	MT20	4.0 4.0 1.25 2.00
C	TMV+p	MT20	3.0 4.0
D	TTW-m	MT20	4.0 4.0
E	TMV+p	MT20	3.0 4.0
F	BMVW1-i	MT20	4.0 4.0
G	BMV+p	MT20	3.0 4.0
H	BMVWW1-i	MT20	6.0 9.0 3.00 2.75
I	BMV1+p	MT20	3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
F	193	0	193	0	0
I	361	0	361	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	136	88 / 0	0 / 0	0 / 0	0 / 0	49 / 0	0 / 0
I	262	181 / 0	0 / 0	0 / 0	0 / 0	72 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO	
A-B	0 / 35	-91.8 -91.8 0.14 (5)	10.00
B-C	-87 / 0	-91.8 -91.8 0.08 (1)	8.25
C-D	-99 / 0	-91.8 -91.8 0.07 (1)	8.25
D-E	-11 / 0	-91.8 -91.8 0.07 (1)	8.25
E-F	-148 / 0	0.0 0.0 0.04 (1)	7.81
F-G	-327 / 0	0.0 0.0 0.02 (4)	7.81
G-H	0 / 8	-18.5 -18.5 0.03 (4)	10.00
H-I	-2 / 8	0.0 0.0 0.05 (1)	10.00
I-J	-203 / 0	0.0 0.0 0.04 (1)	7.81
J-K	0 / 30	-18.5 -18.5 0.03 (1)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 20 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEF. (LL) = L/360 (0.10")
CALCULATED VERT. DEF. (LL) = L/999 (0.00")
ALLOWABLE DEF. (TL) = L/360 (0.10")
CALCULATED VERT. DEF. (TL) = L/999 (0.01")

CSI: TC=0.14/1.00 (A-B-S), BC=0.05/1.00 (G-H-I), WB=0.03/1.00 (D-H-I), SS=0.12/1.00 (D-E-I)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1967 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.23 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007159

JOB NAME 408169	TRUSS NAME T32S	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:48:40 2020 Page 1
ID:K7TPdngj0npt1qYdbWfQFzdeG-EDhw122qGmCave6iXKlj_GFy1ZYDKG4M22T7yIzNBDF

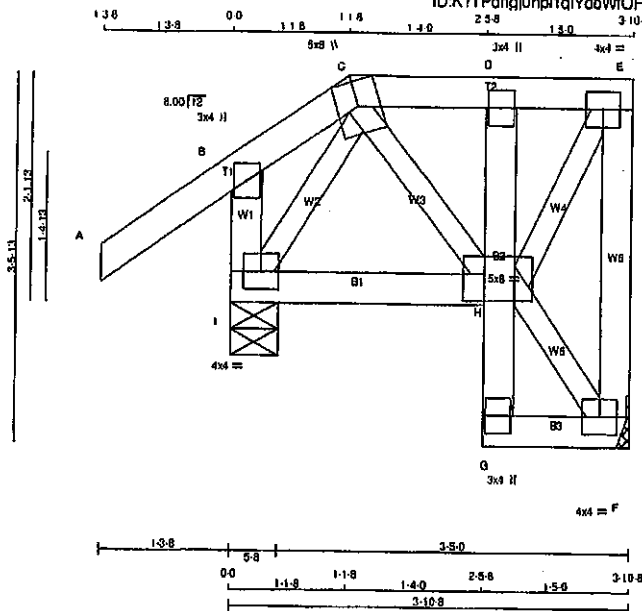

N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2	
C - E	2x4	DRY	No.2	
F - E	2x4	DRY	No.2	
I - B	2x4	DRY	No.2	
I - H	2x4	DRY	No.2	
G - D	2x4	DRY	No.2	
G - F	2x4	DRY	No.2	
ALL WEBS	2x3	DRY	No.2	
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TTWW+m	MT20	5.0	8.0	Edge	
D	TMV+p	MT20	3.0	4.0		
E	TMVW-1	MT20	4.0	4.0		
F	BMVW-1	MT20	4.0	4.0		
G	BMV+p	MT20	3.0	4.0		
H	BMVWVW-1	MT20	5.0	8.0	3.00	2.60
I	BMVW-1	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	191	0	191	0
I	382	0	382	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	138	87 / -12	0 / 0	0 / 0	0 / 0	49 / 0	0 / 0
I	253	182 / 0	0 / 0	0 / 0	0 / 0	71 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS			WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO	UNBRAG LENGTH	FR-TO		
A-B	0 / 35	-91.8 -91.8 0.14 (5)	10.00	C-H	0 / 60	0.01 (1)
B-C	-41 / 0	-91.8 -91.8 0.13 (5)	6.25	H-F	-7 / 0	0.00 (1)
C-D	-89 / 0	-91.8 -91.8 0.02 (1)	8.25	H-E	0 / 153	0.03 (1)
D-E	-88 / 0	-91.8 -91.8 0.02 (1)	8.25	I-C	-100 / 34	0.02 (1)
E-F	-175 / 0	0.0 0.0 0.03 (1)	7.81			
F-G	-253 / 0	0.0 0.0 0.03 (1)	7.81			
I-H	-18 / 53	-18.5 -18.5 0.04 (4)	6.25			
G-H	0 / 13	0.0 0.0 0.01 (1)	10.00			
H-D	-142 / 0	0.0 0.0 0.01 (1)	7.81			
G-F	0 / 5	-18.5 -18.5 0.01 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, CBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CSI: TC=0.14/1.00 (A-B:5), BC=0.04/1.00 (H-I:4),
WB=0.03/1.00 (E-H:1), SS=0.03/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PS)	(PLI)	(PLI)	
MT20	618	354	1867 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.18 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007160

JOB NAME 408169	TRUSS NAME T33	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 Mike Industries, Inc. Sat Apr 25 12:49:41 2020 Page 1			
		ID:K?TPdhgI0npl1qIYdbWOFzIdG-IPFIFC3S14LXohu51pyWUJo8MznVTaTWGIDhUBzNBDC			

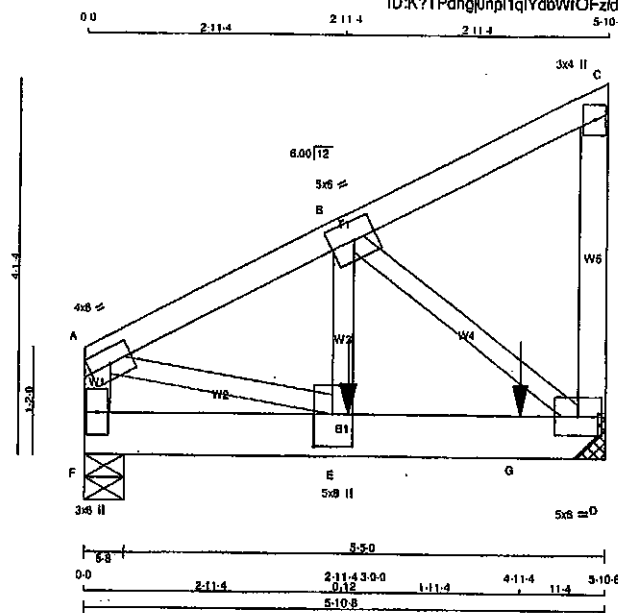

TOTAL WEIGHT = 2 X 29 = 58 lb

LUMBER			
CHORDS	SIZE	LUMBER	DESCR.
F - A	2x4	DRY No.2	SPF
A - C	2x4	DRY No.2	SPF
D - C	2x4	DRY No.2	SPF
F - D	2x4	DRY No.2	SPF
ALL WEBS 2x3 DRY No.2 SPF			
DRY: SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
F - A	12	TOP
A - C	12	TOP
C - D	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
F - D	2	SIDE (305.2)
WEBS: (0.122"x3") SPIRAL NAILS		
B - E	2	SIDE (408.9)
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	4.0	8.0		Edge
B	TMVW-t	MT20	5.0	8.0		
C	TMVW-p	MT20	3.0	4.0		
D	BMVW-t	MT20	5.0	8.0		
E	BMVW-t	MT20	5.0	8.0	4.25	2.50

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
F	1914	0	1914	0	5-8
D	2859	0	2859	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	1348	915 / 0	0 / 0	0 / 0	0 / 0	434 / 0	0 / 0
D	2015	1359 / 0	0 / 0	0 / 0	0 / 0	657 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLINE SPACING = 5.59 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)
F-A	-1877 / 0	0.0	0.0
A-B	-2588 / 0	-91.8	5.59
B-C	-7 / 0	-91.8	10.00
D-C	-120 / 0	0.0	7.81
F-E	0 / 0	-18.5	10.00
E-G	0 / 2301	-18.5	10.00
G-D	0 / 2301	-18.5	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	3-0-0	-2737	-2737	---	BACK	VERT	TOTAL	---	C1
G	4-11-4	-1388	-1388	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/380 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/380 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.10/1.00 (A-F:1), BC=0.49/1.00 (D-E:1),
WB=0.35/1.00 (B-D:1), SS=0.33/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354
1867	788	1987
1656		

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (B) (INPUT = 0.90)
JSI METAL= 0.44 (E) (INPUT = 1.00)



Structural component only
DWG# T-2007161 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408169	T33	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRAUSS DESC.	


Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Sat Apr 25 12:49:41 2020 Page 2
 ID:K?TPdhiQnplqIYabWIOFzIdG-iPF1FO3S14LiXghu51pyWUq8MznVTaTWGiDhUBzNEOC

PLATES (table is in inches)
 JT TYPE PLATES W LEN Y X
 F BMV1+p MT20 3.0 6.0
 Edge - INDICATES REFERENCE CORNER OF PLATE
 TOUCHES EDGE OF CHORD.



Structural component only
 DWG# T-2007161 32

JOB NAME 408170	TRUSS NAME T40	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:15 2020 Page 1	
ID:K?TPdhgJOnp1qYd6WIOFzideG-dToLVC8PTkKk_gKpGOLn4U0ubv6N8cfVf7sayUzNB1c				Scale = 1:57.2	

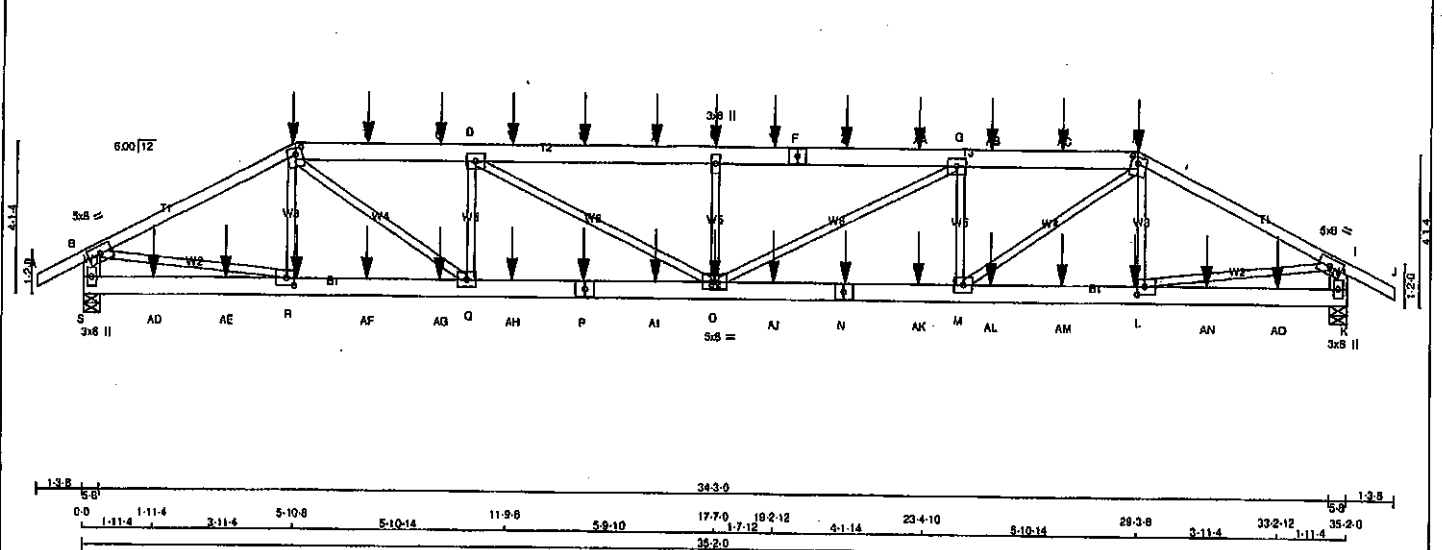

TOTAL WEIGHT = 2 X 169 = 338 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - F	2x6	DRY	No.2
F - H	2x6	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x6	DRY	No.2
K - I	2x6	DRY	No.2
S - P	2x6	DRY	No.2
P - N	2x6	DRY	No.2
N - K	2x6	DRY	No.2

ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
-----------------	-----	-----	------	-----

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	SIDE(81.0)
H - J	12	SIDE(81.0)
C - F	12	SIDE(81.0)
F - H	12	SIDE(81.0)
S - B	12	TOP
K - I	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S - P	12	SIDE(183.1)
P - N	12	SIDE(183.1)
N - K	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3/8 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED		MAXIMUM FACTORED		INPUT	REQD		
GROSS REACTION		GROSS REACTION		BRG	BRG		
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
S	3331	0	3331	0	0	5-8	5-8
K	3331	0	3331	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
COMBINED		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	2358	1544 / 0	0 / 0	0 / 0	0 / 0	812 / 0	0 / 0
K	2358	1544 / 0	0 / 0	0 / 0	0 / 0	812 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.87 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MAX. (PLF)	UNBRAC	MEMB. FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO		LENGTH FR-TO			
A-B	0 / 28	-91.8	-91.8	0.07 (1)	10.00	R-C	-449 / 0
B-C	-5069 / 0	-91.8	-91.8	0.52 (1)	3.87	C-Q	0 / 3021
C-T	-8978 / 0	-91.8	-91.8	0.24 (1)	4.35	Q-D	-1608 / 0
T-U	-8976 / 0	-91.8	-91.8	0.24 (1)	4.35	D-O	0 / 1339
U-D	-8976 / 0	-91.8	-91.8	0.24 (1)	4.35	O-E	-1058 / 0
D-V	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	O-G	0 / 1339
V-W	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	M-G	-1608 / 0
W-X	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	M-H	0 / 3021
X-E	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	L-H	-449 / 0
E-Y	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	B-R	0 / 4585
Y-F	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02	L-I	0 / 4585
F-Z	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02		
Z-AA	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02		
AA-G	-8155 / 0	-91.8	-91.8	0.31 (1)	4.02		
G-AB	-8978 / 0	-91.8	-91.8	0.24 (1)	4.35		
AB-AC	-8976 / 0	-91.8	-91.8	0.24 (1)	4.35		
AC-H	-8976 / 0	-91.8	-91.8	0.24 (1)	4.35		
H-I	-5069 / 0	-91.8	-91.8	0.52 (1)	3.87		
I-J	0 / 28	-91.8	-91.8	0.07 (1)	10.00		
S-B	-3250 / 0	0.0	0.0	0.11 (1)	7.69		
K-I	-3250 / 0	0.0	0.0	0.11 (1)	7.69		

S-AD	0 / 0	-18.5	-18.5	0.07 (4)	10.00
AD-AE	0 / 0	-18.5	-18.5	0.07 (4)	10.00
AE-R	0 / 0	-18.5	-18.5	0.07 (4)	10.00
R-AF	0 / 4557	-18.5	-18.5	0.33 (1)	10.00
AF-AG	0 / 4557	-18.5	-18.5	0.33 (1)	10.00
AG-Q	0 / 4557	-18.5	-18.5	0.33 (1)	10.00
Q-AH	0 / 8975	-18.5	-18.5	0.62 (1)	10.00
AH-P	0 / 8975	-18.5	-18.5	0.52 (1)	10.00
P-AJ	0 / 8975	-18.5	-18.5	0.52 (1)	10.00
AJ-O	0 / 8975	-18.5	-18.5	0.52 (1)	10.00
O-AJ	0 / 8975	-18.5	-18.5	0.52 (1)	10.00
AJ-N	0 / 8975	-18.5	-18.5	0.52 (1)	10.00
N-AK	0 / 8975	-18.5	-18.5	0.52 (1)	10.00
AK-M	0 / 8975	-18.5	-18.5	0.52 (1)	10.00
M-AL	0 / 4557	-18.5	-18.5	0.33 (1)	10.00
AL-AM	0 / 4557	-18.5	-18.5	0.33 (1)	10.00
AM-L	0 / 4557	-18.5	-18.5	0.33 (1)	10.00
L-AN	0 / 0	-18.5	-18.5	0.07 (4)	10.00
AN-AO	0 / 0	-18.5	-18.5	0.07 (4)	10.00
AO-K	0 / 0	-18.5	-18.5	0.07 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = U/999 (0.21")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = U/999 (0.38")

CSI: TC=0.52/1.00 (B-C:1), BC=0.52/1.00 (O-Q:1), WB=0.57/1.00 (B-R:1), SSI=0.18/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1887 788 1887 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (H) (INPUT = 0.90)

JSI METAL= 0.67 (P) (INPUT = 1.00)

Structural component only

DWG# T. 2007168



Structural component only
DWG# T-2007168 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T40	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 13:02:15 2020 Page 2

ID:K7TPdhaQnpl1qYdbWOFzIdeG-dToLVCBPTkkk gKpGOLn4U0ubv6N8cfV1?aaYUzNB1c

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW-1	MT20	5.0	8.0		
C	TTWW-m	MT20	5.0	8.0	2.00	2.25
D	TMW-1	MT20	5.0	8.0		
E	TMW-w	MT20	3.0	8.0		
F	TS-1	MT20	5.0	8.0		
G	TMWW-1	MT20	5.0	8.0		
H	TTWW-m	MT20	5.0	8.0	2.00	2.25
I	TMW-1	MT20	5.0	8.0		
K	BMV1-p	MT20	3.0	6.0		
L	BMWW-1	MT20	5.0	6.0	2.50	2.50
M	BMWW-1	MT20	5.0	6.0		
N	BS-1	MT20	5.0	6.0		
O	BMWW-1	MT20	5.0	6.0		
P	BS-1	MT20	5.0	6.0		
Q	BMWW-1	MT20	5.0	6.0		
R	BMWW-1	MT20	5.0	6.0	2.50	2.50
S	BMV1-p	MT20	3.0	6.0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-437	-437	---	FRONT	VERT	TOTAL	---	C1
E	17-7-0	-110	-110	---	FRONT	VERT	TOTAL	---	C1
L	29-3-8	-437	-437	---	FRONT	VERT	TOTAL	---	C1
N	29-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
H	21-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
O	17-7-0	-26	-26	---	FRONT	VERT	TOTAL	---	C1
P	13-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	19-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AC	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AD	1-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AE	3-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	7-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AG	9-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AH	11-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AI	15-11-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AJ	19-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AK	23-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AL	25-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AM	27-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AN	31-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AO	33-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007168

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T40Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 9 Oct 28 2019 MITek Industries, Inc. Sat Apr 25 13:02:17 2020 Page 2
ID:K?TPdhl0npl1qlYdbW/QFzldG-arw5vuDf MaSDzUBNoNF9v6Buik?cSGo6JLh0NzNB1a

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	2.00	3.50
C	TTWW+m	MT20	8.0	9.0	Edge	
D	TMWW-t	MT20	5.0	8.0		
E	TMW+u	MT20	3.0	8.0		
F	TS-t	MT20	5.0	8.0		
G	TMWW-t	MT20	5.0	8.0		
H	TTWW+m	MT20	8.0	9.0	Edge	
I	TMVW-p	MT20	5.0	8.0	2.00	3.50
K	BMV1+p	MT20	3.0	8.0		
L	BMWW-t	MT20	5.0	8.0	2.50	3.25
M	BMWW+t	MT20	8.0	9.0	4.50	2.50
N	BS-t	MT20	5.0	8.0		
O	BMWWW-t	MT20	5.0	8.0		
P	BS-t	MT20	5.0	8.0		
Q	BMWW+t	MT20	8.0	9.0	4.50	2.50
R	BMWW-t	MT20	8.0	8.0	2.50	3.25
S	BMV1+p	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007169 3/2

JOB NAME 408170	TRUSS NAME T41	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 13:02:18 2020 Page 1
ID:K?TPdhgJ0npl1qYdbWIOFZdeG-22UT7EDHifj73OxWuU8aJ865BLvLxLz4FZpZNB1Z

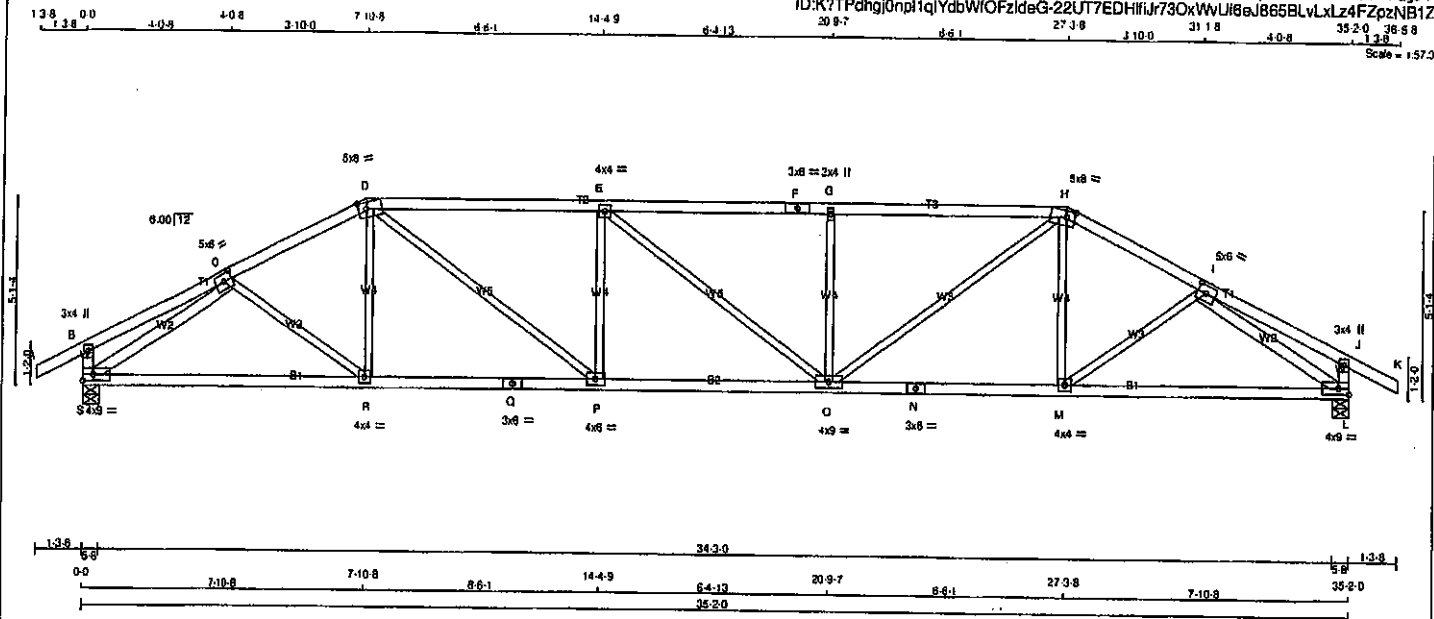

TOTAL WEIGHT = 2 X 139 = 278 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - F	2x4	DRY	No.2	SPF		
F - H	2x4	DRY	No.2	SPF		
H - K	2x4	DRY	No.2	SPF		
S - B	2x4	DRY	No.2	SPF		
L - J	2x4	DRY	No.2	SPF		
S - Q	2x4	DRY	No.2	SPF		
O - N	2x4	DRY	No.2	SPF		
N - L	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						
S - C	2x4	DRY	No.2	SPF		
I - L	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMVW-1	MT20	5.0	6.0	2.50	2.75
D TTWW-m	MT20	5.0	8.0	2.25	2.75
E TMVW-1	MT20	4.0	4.0		
F TS-1	MT20	3.0	8.0		
G TMV+w	MT20	2.0	4.0		
H TTWW-m	MT20	5.0	8.0	2.25	2.75
I TMVW-1	MT20	5.0	8.0	2.50	2.75
J TMV+p	MT20	3.0	4.0		
L BMVW-1	MT20	4.0	9.0		Edge
M BMVW-1	MT20	4.0	4.0		
N BS-1	MT20	3.0	8.0		
O BMVW-1	MT20	4.0	9.0		
P BMVW-1	MT20	4.0	8.0		
Q BS-1	MT20	3.0	8.0		
R BMVW-1	MT20	4.0	4.0		
S BMVW-1	MT20	4.0	9.0		Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORIZ	UP	BRG	IN-SX	BRG
S	2063	0	2063	0	0	0	5-8	5-8	
L	2063	0	2063	0	0	0	5-8	5-8	

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN	COMPONENT REACTIONS	PERM	LIVE	WIND	DEAD	SOIL
JT COMBINED							
S	1457	969 / 0	0 / 0	0 / 0	0 / 0	468 / 0	0 / 0
L	1457	969 / 0	0 / 0	0 / 0	0 / 0	468 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.94 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0 / 28	-91.8 -91.8	0.12 (1)	10.00	C-R	0 / 93	0.03 (4)
B-C	0 / 16	-91.8 -91.8	0.20 (1)	10.00	R-D	0 / 121	0.04 (4)
C-D	-2799 / 0	-91.8 -91.8	0.32 (1)	3.88	D-P	0 / 1267	0.29 (1)
D-E	-3508 / 0	-91.8 -91.8	0.85 (1)	2.94	P-E	-643 / 0	0.25 (1)
E-F	-3507 / 0	-91.8 -91.8	0.93 (1)	2.94	E-Q	-2 / 0	0.00 (1)
F-G	-3507 / 0	-91.8 -91.8	0.93 (1)	2.94	O-G	-643 / 0	0.25 (1)
G-H	-3507 / 0	-91.8 -91.8	0.84 (1)	2.95	O-H	0 / 1268	0.28 (1)
H-I	-2799 / 0	-91.8 -91.8	0.32 (1)	3.88	M-H	0 / 121	0.04 (4)
I-J	0 / 16	-91.8 -91.8	0.20 (1)	10.00	M-I	0 / 93	0.03 (4)
J-K	0 / 28	-91.8 -91.8	0.12 (1)	10.00	S-C	-2974 / 0	0.83 (1)
S-B	-270 / 0	0.0 0.0	0.03 (1)	7.81	I-L	-2974 / 0	0.83 (1)
L-J	-270 / 0	0.0 0.0	0.03 (1)	7.81			
S-R	0 / 2417	-18.5 -18.5	0.53 (1)	10.00			
R-Q	0 / 2469	-18.5 -18.5	0.54 (1)	10.00			
Q-P	0 / 2469	-18.5 -18.5	0.54 (1)	10.00			
P-O	0 / 2509	-18.5 -18.5	0.64 (1)	10.00			
O-N	0 / 2469	-18.5 -18.5	0.54 (1)	10.00			
N-M	0 / 2469	-18.5 -18.5	0.54 (1)	10.00			
M-L	0 / 2417	-18.5 -18.5	0.53 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCG 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.41")

CSI: TC=0.85/1.00 (D-E:1), BC=0.84/1.00 (O-P:1), WB=0.83/1.00 (L:1), SSI=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1687 788	1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.69 (L) (INPUT = 0.50)
JSI METAL= 0.77 (N) (INPUT = 1.00)

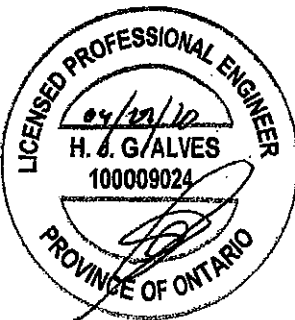

Structural component only
DWG# T-2007170

JOB NAME 408170	TRUSS NAME T42	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 5 Oct 29 2019 Mtek Industries, Inc. Sat Apr 25 13:02:19 2020 Page 1
 ID:K7TPdhgi0npl1qIYdbWOFzIdeG-WE2iKaEwWz9THdaVEQIEKBSUWUW4PP4adqo5FzNB1Y
 Scale = 1/8" = 1'-0"

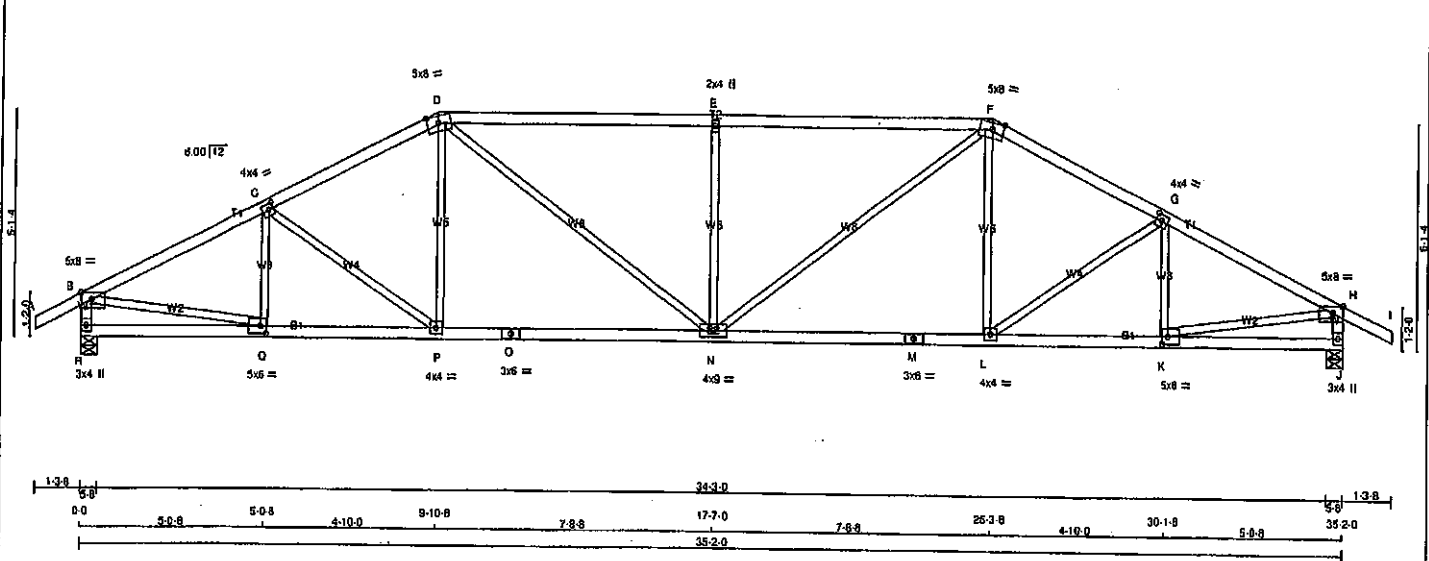

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - I	2x4	DRY No.2	SPF
R - B	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
R - D	2x4	DRY No.2	SPF
O - M	2x4	DRY No.2	SPF
M - J	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	8.0	Edge 3.50
C	TMWV-l	MT20	4.0	4.0	2.00 1.75
D	TTWV-m	MT20	5.0	8.0	2.25 3.75
E	TMWV-w	MT20	2.0	4.0	
F	TTWV-m	MT20	5.0	8.0	2.25 3.75
G	TMWV-l	MT20	4.0	4.0	2.00 1.75
H	TMWV-p	MT20	5.0	8.0	Edge 3.50
J	BMV-l-p	MT20	3.0	4.0	
K	BMWV-l	MT20	5.0	6.0	2.50 2.00
L	BMWV-l	MT20	4.0	4.0	
M	BS-l	MT20	3.0	6.0	
N	BMWVW-l	MT20	4.0	9.0	
O	BS-l	MT20	3.0	6.0	
P	BMWV-l	MT20	4.0	4.0	
Q	BMWV-l	MT20	5.0	8.0	2.50 2.00
R	BMV-l-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
R	2083	0	2083	0	5-8	5-8
J	2083	0	2083	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE		MAX/MIN COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
J	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.78 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS					WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM	TO		FR-TO			
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	Q-C	-353 / 0	0.08 (1)
B-C	-2834 / 0	-91.8	-91.8	0.39 (1)	3.81	C-P	-210 / 0	0.13 (1)
C-D	-2887 / 0	-91.8	-91.8	0.37 (1)	3.91	P-D	0 / 246	0.08 (4)
D-E	-3080 / 0	-91.8	-91.8	0.37 (1)	2.78	D-N	0 / 844	0.19 (1)
E-F	-3080 / 0	-91.8	-91.8	0.37 (1)	2.78	N-E	-872 / 0	0.51 (1)
F-G	-2887 / 0	-91.8	-91.8	0.37 (1)	3.91	N-F	0 / 844	0.19 (1)
G-H	-2834 / 0	-91.8	-91.8	0.39 (1)	3.81	L-F	0 / 246	0.06 (4)
H-I	0 / 28	-91.8	-91.8	0.12 (1)	10.00	L-G	-210 / 0	0.13 (1)
R-B	-2018 / 0	0.0	0.0	0.20 (1)	5.94	K-G	-353 / 0	0.08 (1)
J-H	-2018 / 0	0.0	0.0	0.20 (1)	5.94	B-Q	0 / 2591	0.58 (1)
						K-H	0 / 2591	0.58 (1)
R-Q	0 / 0	-18.5	-18.5	0.10 (4)	10.00			
Q-P	0 / 2555	-18.5	-18.5	0.51 (1)	10.00			
P-O	0 / 2388	-18.5	-18.5	0.49 (1)	10.00			
O-N	0 / 2388	-18.5	-18.5	0.49 (1)	10.00			
N-M	0 / 2388	-18.5	-18.5	0.49 (1)	10.00			
M-L	0 / 2388	-18.5	-18.5	0.49 (1)	10.00			
L-K	0 / 2555	-18.5	-18.5	0.51 (1)	10.00			
K-J	0 / 0	-18.5	-18.5	0.10 (4)	10.00			

TOTAL WEIGHT = 2 X 139 = 277 lb (MIF)

DESIGN CRITERIA
 SPECIFIED LOADS:
 TOP CH. LL = 25.8 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF
 SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2010
 - PART 9 OF CBC 2012 (2018 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.17")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.34")

CSI: TC=0.97/1.00 (D-E:1), BC=0.51/1.00 (P-Q:1), WB=0.58/1.00 (B-C:1), SI=0.34/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP (DRY) SHEAR SECTION (PS) (PL) (PL)
 MAX MIN MAX MIN MAX MIN
 MT20 518 354 1667 788 1987 1698

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.87 (F) (INPUT = 0.80)
 JSI METAL = 0.75 (M) (INPUT = 1.00)



Structural component only
 DWG# T-2007171

JOB NAME 408170	TRUSS NAME T43	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:20 2020 Page 1
 ID:K?TPdHg0npl1qYd0W0FzIdaG- QcEYwFYHh04Rcm3xxynXkIMwq0psVEoHZLdzNB1X
 Scale = 1:57.3

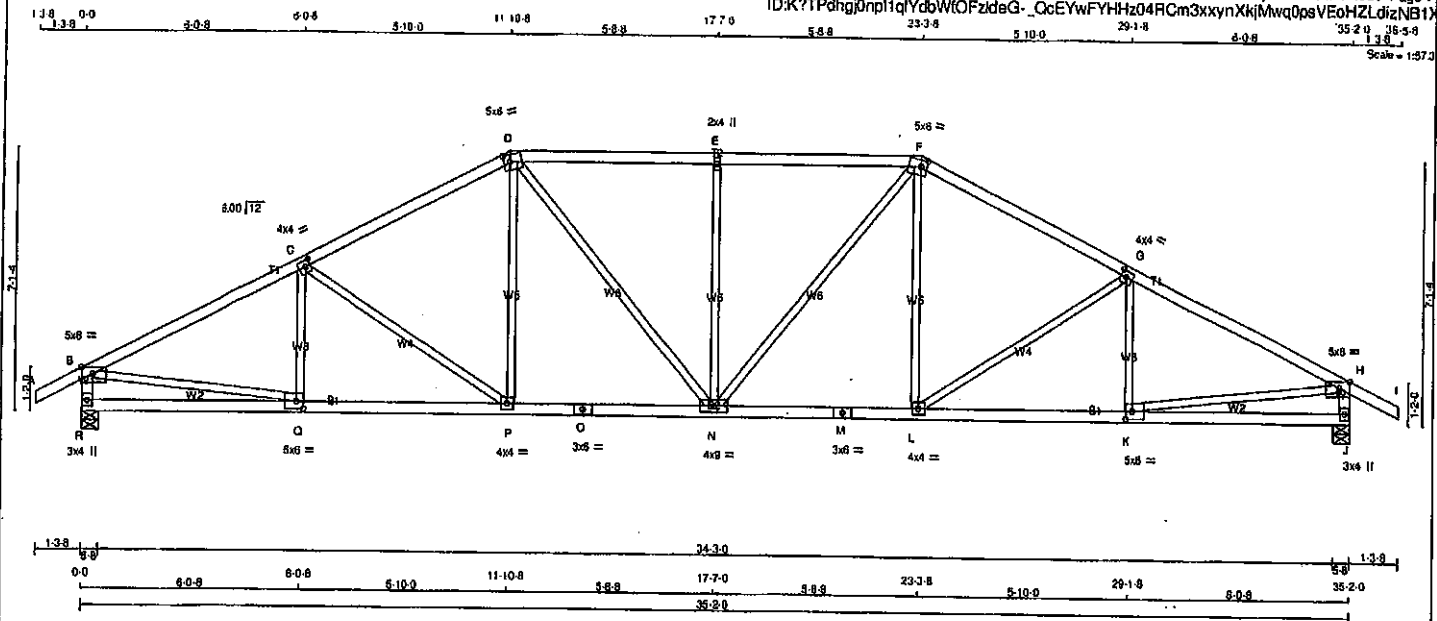

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN
B	TMVW-p	MT20	5.0	8.0
C	TMWW-t	MT20	4.0	4.0
D	TTWW-m	MT20	5.0	6.0
E	TMW-w	MT20	2.0	4.0
F	TTWW-m	MT20	5.0	8.0
G	TMWW-t	MT20	4.0	4.0
H	TMVW-p	MT20	5.0	8.0
J	BMV1-p	MT20	3.0	4.0
K	BMWW-t	MT20	5.0	6.0
L	BMWW-t	MT20	4.0	4.0
M	BS-t	MT20	3.0	6.0
N	BMWW-t	MT20	4.0	4.0
O	BS-t	MT20	3.0	6.0
P	BMWW-t	MT20	4.0	4.0
Q	BMWW-t	MT20	5.0	6.0
R	BMV1-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	BRG	UPLIFT	IN-SX	IN-SX
R	2063	0	2063	0	0	5-8	5-8	5-8	5-8
J	2063	0	2063	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX/MIN COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM	LIVE
R	1457	969 / 0	0 / 0	0 / 0	0 / 0
J	1457	969 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)	
CHORDS		MEMB.	
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
FR-TO			
A-B	0 / 28	-91.8	10.00
B-C	-2889 / 0	-91.8	3.58
C-D	-2539 / 0	-91.8	3.83
D-E	-2559 / 0	-91.8	3.85
E-F	-2589 / 0	-91.8	3.85
F-G	-2539 / 0	-91.8	3.83
G-H	-2889 / 0	-91.8	3.68
H-I	0 / 28	-91.8	10.00
I-J	-2014 / 0	0.0	5.95
J-K	-2014 / 0	0.0	5.95
K-H	0 / 0	-18.5	10.00
Q-P	0 / 2809	-18.5	10.00
P-O	0 / 2249	-18.5	10.00
O-N	0 / 2249	-18.5	10.00
N-M	0 / 2249	-18.5	10.00
M-L	0 / 2249	-18.5	10.00
L-K	0 / 2809	-18.5	10.00
K-J	0 / 0	-18.5	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.26")

CSI: TC=0.58/1.00 (B-C:1), BC=0.49/1.00 (P-Q:1), WB=0.59/1.00 (B-Q:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES		PLATE GRIP(DRY) SHEAR		SECTION	
(PSI)	(PLI)	(PSI)	(PLI)	MAX	MIN
MT20	618	354	1687	788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (Q) (INPUT = 0.90)
 JSI METAL = 0.89 (M) (INPUT = 1.00)




Structural component only
 DWG# T-2007172

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408170	T44	2	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 25 13:02:21 2020 Page 1
ID:K?TPdhi0npl1qYdbWOFzIdeG-SdAd(GGA2a5libnycfSBKIGrDK9)YJhN1x.lv98zNB1W

Scale = 1:50.0

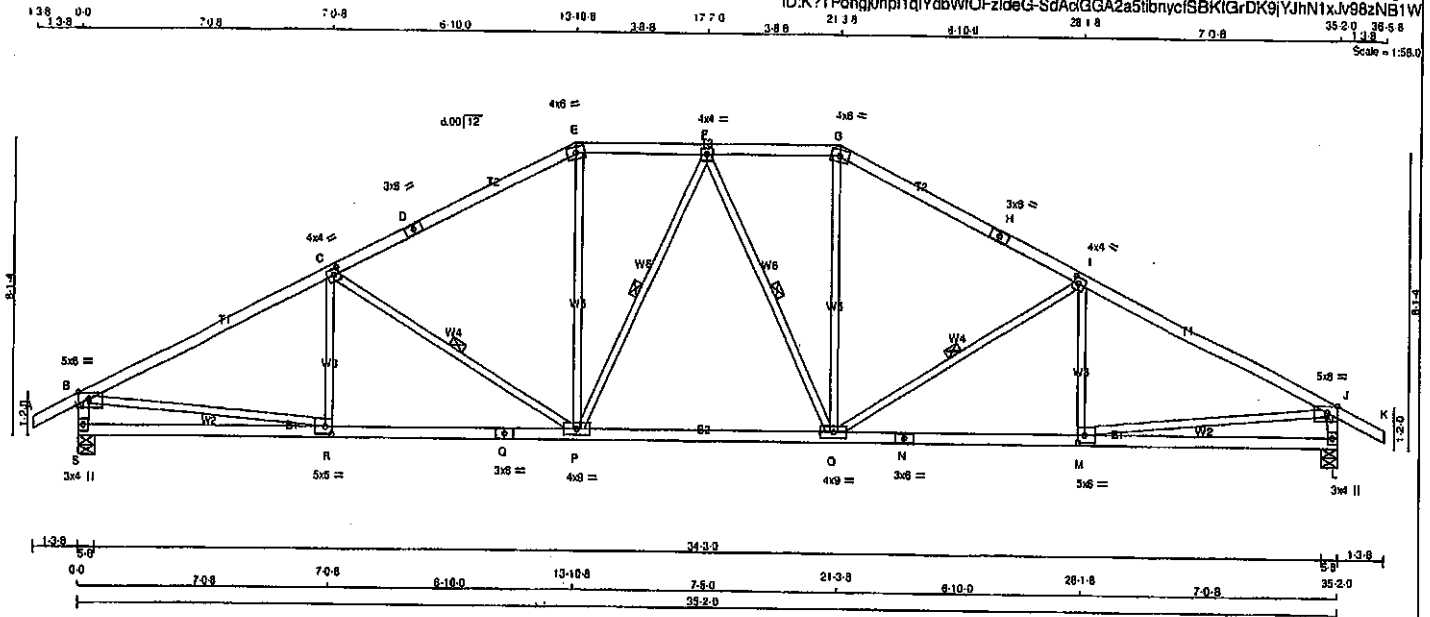

LUMBER	N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	A - D	2x4	DRY	No.2
	D - E	2x4	DRY	No.2
	E - G	2x4	DRY	No.2
	G - H	2x4	DRY	No.2
	H - K	2x4	DRY	No.2
	S - B	2x4	DRY	No.2
	L - J	2x4	DRY	No.2
	S - Q	2x4	DRY	No.2
	Q - N	2x4	DRY	No.2
	N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	Edge	3.50
C TMVW-t	MT20	4.0	4.0	2.00	1.75
D TS-t	MT20	3.0	6.0		
E TTW-m	MT20	4.0	6.0		
F TMVW-t	MT20	4.0	4.0		
G TTW-m	MT20	4.0	6.0		
H TS-t	MT20	3.0	6.0		
I TMVW-t	MT20	4.0	4.0	2.00	1.75
J TMVW-p	MT20	5.0	8.0	Edge	3.50
L BMV-t	MT20	3.0	4.0		
M BMVW-t	MT20	5.0	8.0	2.50	2.25
N SS-t	MT20	3.0	6.0		
O BMVW-t	MT20	4.0	9.0		
P BMVW-t	MT20	4.0	9.0		
Q SS-t	MT20	3.0	6.0		
R BMVW-t	MT20	5.0	8.0	2.50	2.25
S BMV-t	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	UP	IN-SX
S	2083	0	5-8	5-8
L	2083	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1457	989 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-P, F-P, F-Q, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. UNBRACED LENGTH (LC)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)
FR-TO					FR-TO			
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	R-C	-182 / 52	0.06 (1)
B-C	-2906 / 0	-91.8	-91.8	0.83 (1)	3.25	C-P	-637 / 0	0.29 (1)
C-D	-2373 / 0	-91.8	-91.8	0.72 (1)	3.68	P-E	0 / 674	0.15 (1)
D-E	-2373 / 0	-91.8	-91.8	0.72 (1)	3.68	F-O	-222 / 0	0.11 (1)
E-F	-2100 / 0	-91.8	-91.8	0.19 (1)	4.53	F-O	-222 / 0	0.11 (1)
F-G	-2100 / 0	-91.8	-91.8	0.19 (1)	4.53	O-G	0 / 674	0.15 (1)
G-H	-2373 / 0	-91.8	-91.8	0.72 (1)	3.68	O-I	-837 / 0	0.29 (1)
H-I	-2373 / 0	-91.8	-91.8	0.72 (1)	3.68	M-I	-182 / 52	0.08 (1)
I-J	-2906 / 0	-91.8	-91.8	0.83 (1)	3.25	B-R	0 / 2649	0.80 (1)
J-K	0 / 28	-91.8	-91.8	0.12 (1)	10.00	M-J	0 / 2649	0.80 (1)
S-B	-2008 / 0	0.0	0.0	0.20 (1)	5.96			
L-J	-2008 / 0	0.0	0.0	0.20 (1)	5.96			
S-R	0 / 0	-18.5	-18.5	0.20 (4)	10.00			
R-Q	0 / 2630	-18.5	-18.5	0.52 (1)	10.00			
Q-P	0 / 2630	-18.5	-18.5	0.52 (1)	10.00			
P-O	0 / 2193	-18.5	-18.5	0.45 (1)	10.00			
O-N	0 / 2630	-18.5	-18.5	0.52 (1)	10.00			
N-M	0 / 2630	-18.5	-18.5	0.52 (1)	10.00			
M-L	0 / 0	-18.5	-18.5	0.20 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

[55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD] EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CSI: TC=0.83/1.00 (B-C:1), EC=0.52/1.00 (P-R:1),
WB=0.60/1.00 (B-R:1), SS=0.28/1.00 (B-C:1)

DOI LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.88 (M) (INPUT = 0.80)

JSI METAL = 0.79 (Q) (INPUT = 1.00)

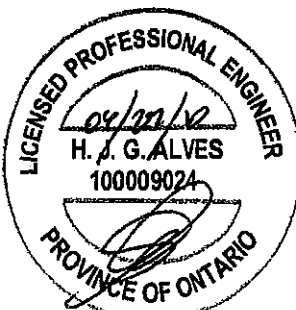

Structural component only
DWG# T-2007173

JOB NAME 408170	TRUSS NAME T45	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
Tamarack Roof Truss, Burlington						
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:22 2020 Page 1						
ID:K?TPdhg0npl1q1YbWIOFzIdaG-wp1_zbGopuDKKIM9AMzQsyb6j1VPHlyXOb2SiazNB1V						
Scale = 1/8" = 1'-0"						

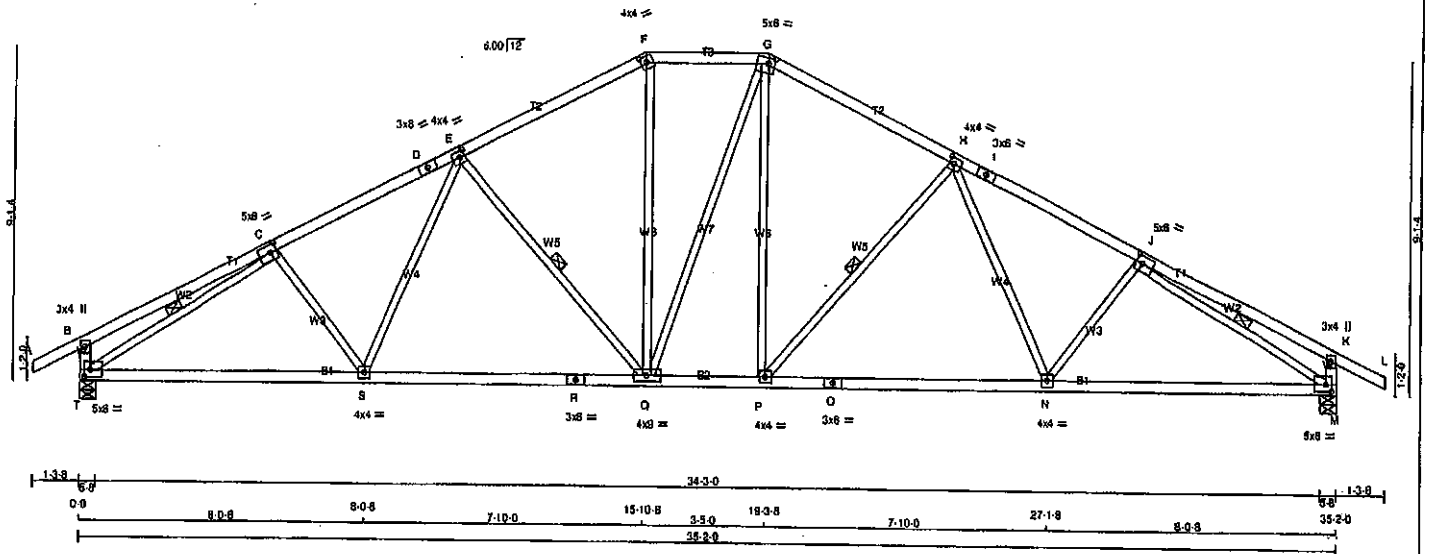

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
L - K	2x4	DRY	No.2
M - B	2x4	DRY	No.2
T - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMV+p	MT20	3.0	4.0	
C TMWW-i	MT20	5.0	8.0	2.50 2.25
D TS-i	MT20	3.0	6.0	
E TMWW-i	MT20	4.0	4.0	2.00 1.50
F TTW-h	MT20	4.0	4.0	2.00 1.75
G TTWW-m	MT20	5.0	8.0	2.00 2.00
H TMWW-i	MT20	4.0	4.0	2.00 1.50
I TS-i	MT20	3.0	6.0	
J TMWW-i	MT20	5.0	8.0	2.50 2.25
K TMV+p	MT20	3.0	4.0	
M BMVW-i	MT20	5.0	8.0	2.25 2.00
N, P, S				
N BMWW-i	MT20	4.0	4.0	
O BS-i	MT20	3.0	6.0	
Q BMWW-i	MT20	4.0	8.0	
R BS-i	MT20	3.0	6.0	
T BMVW-i	MT20	5.0	8.0	2.25 2.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
	FACTORED	MAXIMUM FACTORED	INPUT	REQD					
	GROSS REACTION	GROSS REACTION	BRG	BRG					
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
T	2063	0	2063	0	0	5-8	5-8		
M	2063	0	2063	0	0	5-8	5-8		
UNFACTORED REACTIONS									
	1ST LCASE	MAX/MIN	COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
T	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0		
M	1457	969 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, H-P, C-T, J-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO					FR-TO				
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	C-S	-110 / 37	0.04 (1)		
B-C	0 / 19	-91.8	-91.8 0.32 (1)	10.00	S-E	0 / 276	0.08 (1)		
C-D	-2759 / 0	-91.8	-91.8 0.40 (1)	3.88	E-Q	-681 / 0	0.31 (1)		
D-E	-2759 / 0	-91.8	-91.8 0.40 (1)	3.88	Q-F	0 / 613	0.14 (1)		
E-F	-2167 / 0	-91.8	-91.8 0.38 (1)	4.30	F-G	0 / 4	0.00 (1)		
F-G	-1925 / 0	-91.8	-91.8 0.18 (1)	4.71	P-G	0 / 609	0.14 (1)		
G-H	-2166 / 0	-91.8	-91.8 0.38 (1)	4.30	P-H	-682 / 0	0.31 (1)		
H-I	-2760 / 0	-91.8	-91.8 0.40 (1)	3.88	H-N	0 / 278	0.06 (1)		
I-J	-2760 / 0	-91.8	-91.8 0.40 (1)	3.88	N-J	-110 / 37	0.04 (1)		
J-K	0 / 19	-91.8	-91.8 0.32 (1)	10.00	T-C	-3040 / 0	0.85 (1)		
K-L	0 / 28	-91.8	-91.8 0.12 (1)	10.00	J-M	-3041 / 0	0.85 (1)		
T-B	-328 / 0	0.0	0.0 0.03 (1)	7.81					
M-K	-328 / 0	0.0	0.0 0.03 (1)	7.81					
T-S	0 / 2536	-18.5	-18.5 0.55 (1)	10.00					
S-R	0 / 2362	-18.5	-18.5 0.53 (1)	10.00					
R-O	0 / 2362	-18.5	-18.5 0.53 (1)	10.00					
Q-P	0 / 1924	-18.5	-18.5 0.40 (1)	10.00					
P-O	0 / 2362	-18.5	-18.5 0.53 (1)	10.00					
O-N	0 / 2362	-18.5	-18.5 0.53 (1)	10.00					
N-M	0 / 2537	-18.5	-18.5 0.55 (1)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
OL = 6.0 PSF
BOT CH. LL = 0.0 PSF
OL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.32")

CSI: TC=0.40/1.00 (H-J:1), BC=0.58/1.00 (M-N:1), WB=0.85/1.00 (J-M:1), SS=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TEN=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (M) (INPUT = 0.90)
JSI METAL = 0.78 (O) (INPUT = 1.00)




Structural component only
DWG# T-2007174

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T46	6	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:23 2020 Page 1
ID:K7TPdhgJ0npl1q/YdbWIOFzKdeG-O?HMAxHQA CLbxuxLk4UIPALGz7q50ADgUF6?E1zNB1U
23-4 29-2 35-2 38-5 1-3-8
Scale = 1/8" = 1'-0"

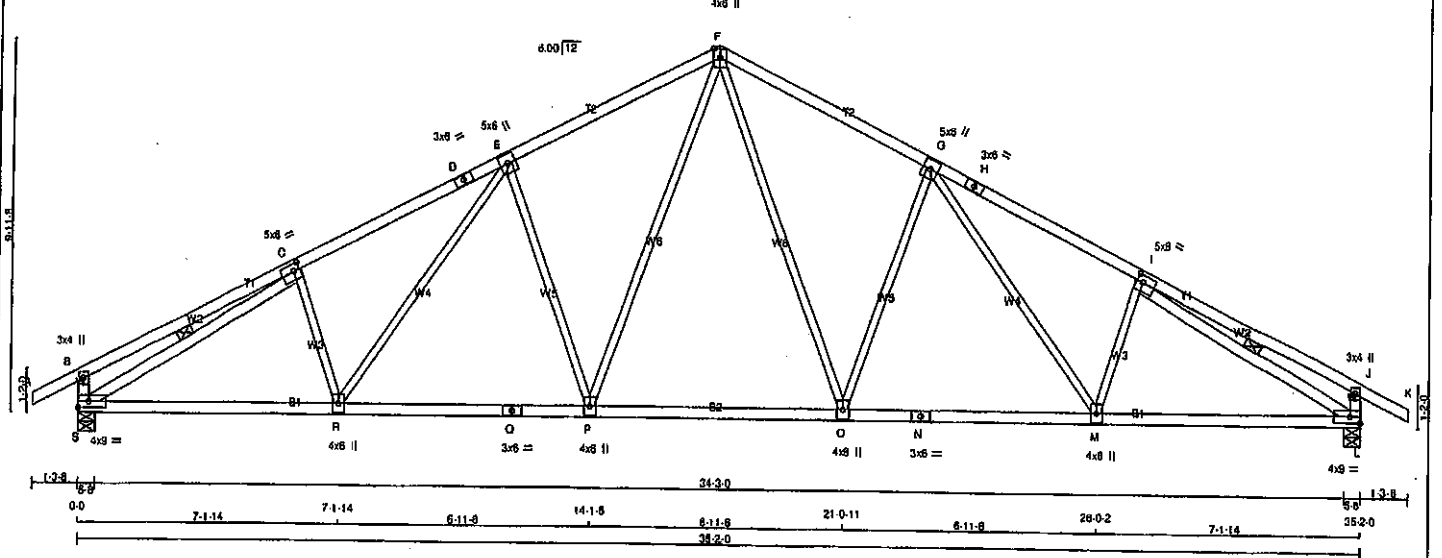

LUMBER						
N. L. G. A. RULES						
CHORDS		SIZE		LUMBER		DESCR.
A - D	2x4	DRY		No.2		SPF
D - F	2x4	DRY		No.2		SPF
F - H	2x4	DRY		No.2		SPF
H - K	2x4	DRY		No.2		SPF
S - B	2x4	DRY		No.2		SPF
L - J	2x4	DRY		No.2		SPF
S - Q	2x4	DRY		No.2		SPF
Q - N	2x4	DRY		No.2		SPF
N - L	2x4	DRY		No.2		SPF
ALL WEBS		2x3	DRY	No.2		SPF
EXCEPT						
S - C	2x4	DRY		No.2		SPF
I - L	2x4	DRY		No.2		SPF
DRY: SEASONED LUMBER.						

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0			
C TMWW+1	MT20	5.0	6.0	2.25	2.00	
D TS-1	MT20	3.0	6.0			
E TMWW+1	MT20	5.0	6.0			
F TTWW+p	MT20	4.0	6.0	Edge		
G TMWW+1	MT20	5.0	6.0			
H TS-1	MT20	3.0	6.0			
I TMWW+1	MT20	5.0	6.0	2.25	2.00	
J TMV+p	MT20	3.0	4.0			
L BMVW+1	MT20	4.0	9.0	Edge		
M, O, P, R						
M BMVW+1	MT20	4.0	6.0			
N BS-1	MT20	3.0	6.0			
Q BS-1	MT20	3.0	6.0			
S BMVW+1	MT20	4.0	9.0	Edge		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
S	2063	0	2063	0
L	2063	0	2063	0

UNFACTORED REACTIONS

1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	COMBINED					
S	1467	969 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1467	969 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)
FR-TO						FR-TO				
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	F-O	0 / 868	0.19 (1)		
B-C	0 / 22	-91.8	-91.8	0.40 (1)	10.00	O-G	-728 / 0	0.72 (1)		
C-D	-2808 / 0	-91.8	-91.8	0.49 (1)	3.75	G-M	0 / 391	0.09 (1)		
D-E	-2808 / 0	-91.8	-91.8	0.49 (1)	3.75	M-I	-192 / 18	0.05 (1)		
E-F	-2322 / 0	-91.8	-91.8	0.48 (1)	4.07	P-F	0 / 868	0.19 (1)		
F-G	-2322 / 0	-91.8	-91.8	0.46 (1)	4.07	E-P	-728 / 0	0.72 (1)		
G-H	-2808 / 0	-91.8	-91.8	0.49 (1)	3.75	R-E	0 / 391	0.09 (1)		
H-I	-2808 / 0	-91.8	-91.8	0.49 (1)	3.75	C-R	-192 / 18	0.05 (1)		
I-J	0 / 22	-91.8	-91.8	0.12 (1)	10.00	S-C	-3064 / 0	0.72 (1)		
J-K	0 / 28	-91.8	-91.8	0.12 (1)	10.00	I-L	-3064 / 0	0.72 (1)		
S-B	-344 / 0	0.0	0.0	0.03 (1)	7.81					
L-J	-344 / 0	0.0	0.0	0.03 (1)	7.81					
S-R	0 / 2574	-18.5	-18.5	0.53 (1)	10.00					
R-Q	0 / 2291	-18.5	-18.5	0.47 (1)	10.00					
Q-P	0 / 2291	-18.5	-18.5	0.47 (1)	10.00					
P-O	0 / 1782	-18.5	-18.5	0.38 (1)	10.00					
O-N	0 / 2291	-18.5	-18.5	0.47 (1)	10.00					
N-M	0 / 2291	-18.5	-18.5	0.47 (1)	10.00					
M-L	0 / 2574	-18.5	-18.5	0.53 (1)	10.00					

TOTAL WEIGHT = 6 X 152 = 910 lb [M] [F]

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2010
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/998 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/998 (0.28")

CSI: TC=0.49/1.00 (G-I:1), BC=0.53/1.00 (R-S:1),
WB=0.72/1.00 (E-P:1), SS=0.22/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (C) (INPUT = 0.90)
JSI METAL = 0.77 (I) (INPUT = 1.00)




Structural component only
DWG# T-2007175

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408170	T47	1	2	GREEN PARK HOMES		

Tamareck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:24 2020 Page 1
ID:K?TPdhgJ0npl1qYdbWfOfzideG-sCrkNH12LVTSZ2WXIn?uxNuSFX8aliOpjvXZmTzNB1T

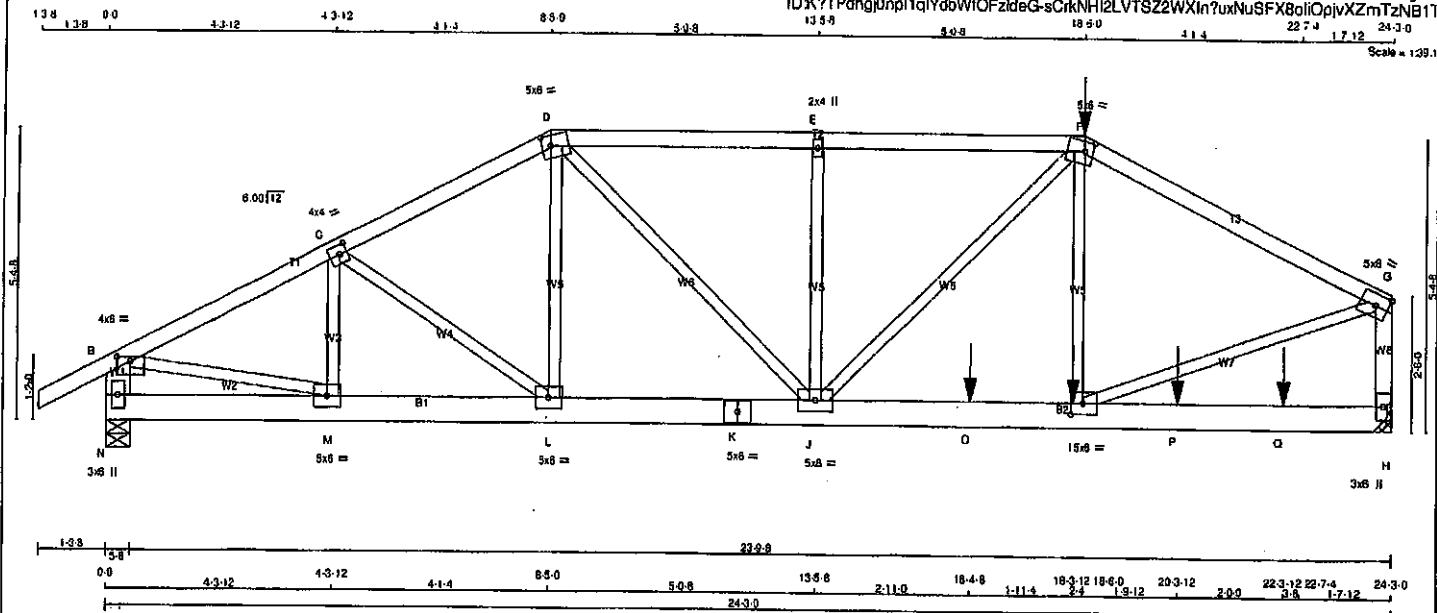

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - F	2x4	DRY	No.2	SPF		
F - G	2x4	DRY	No.2	SPF		
N - B	2x6	DRY	No.2	SPF		
H - G	2x4	DRY	No.2	SPF		
N - K	2x6	DRY	No.2	SPF		
K - H	2x6	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS	ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122'x3") SPIRAL NAILS			
A-D	1	12	TOP
D-F	1	12	SIDE(61.0)
F-G	1	12	SIDE(61.0)
H-G	1	12	TOP
N-B	2	12	TOP
BOTTOM CHORDS : (0.122'x3") SPIRAL NAILS			
N-K	2	12	TOP
K-H	2	12	SIDE(183.1)
WEBS : (0.122'x3") SPIRAL NAILS			
2x3	1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	BRG	IN-SX	IN-SX
N	2120	0	2120	0	0	5-8	5-8		
H	3119	0	3119	0	0	MECHANICAL			

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 4-0.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
N	1495	1003 / 0	0 / 0	0 / 0	0 / 0	492 / 0	0 / 0
H	2201	1472 / 0	0 / 0	0 / 0	0 / 0	729 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.64 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 28	-91.8	-91.8 0.07 (1)	10.00	M-C	-408 / 0	0.04 (1)
B-C	-2914 / 0	-91.8	-91.8 0.17 (1)	5.22	C-L	-68 / 0	0.01 (1)
C-D	-2892 / 0	-91.8	-91.8 0.17 (1)	5.24	L-D	0 / 70	0.01 (4)
D-E	-3517 / 0	-91.8	-91.8 0.27 (1)	4.74	D-J	0 / 1336	0.17 (1)
E-F	-3517 / 0	-91.8	-91.8 0.27 (1)	4.74	J-E	-565 / 0	0.12 (1)
F-G	-3466 / 0	-91.8	-91.8 0.39 (1)	4.84	J-F	0 / 575	0.07 (1)
N-B	-2084 / 0	0.0	0.0 0.07 (1)	7.81	I-F	0 / 522	0.06 (1)
H-G	-2933 / 0	0.0	0.0 0.20 (1)	6.72	I-G	0 / 3293	0.41 (1)
					B-M	0 / 2684	0.33 (1)
N-M	0 / 0	-18.5	-18.5 0.03 (1)	10.00			
M-L	0 / 2622	-18.5	-18.5 0.21 (1)	10.00			
L-K	0 / 2568	-18.5	-18.5 0.33 (1)	10.00			
K-J	0 / 2568	-18.5	-18.5 0.33 (1)	10.00			
J-O	0 / 3109	-18.5	-18.5 0.69 (1)	10.00			
O-I	0 / 3109	-18.5	-18.5 0.69 (1)	10.00			
I-P	0 / 0	-18.5	-18.5 0.32 (1)	10.00			
P-Q	0 / 0	-18.5	-18.5 0.32 (1)	10.00			
Q-H	0 / 0	-18.5	-18.5 0.32 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	18-6-0	-178	-178		FRONT	VERT	TOTAL		C1
I	18-3-12	-35	-35		FRONT	VERT	TOTAL		C1
O	18-4-8	-1661	-1661		FRONT	VERT	TOTAL		C1
P	20-3-12	-283	-283		FRONT	VERT	TOTAL		C1
Q	22-3-12	-284	-284		FRONT	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 114 = 228 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBCO 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.81")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.39/1.00 (F-G-I), BC=0.69/1.00 (I-J-I), WB=0.41/1.00 (G-I-I), SSI=0.37/1.00 (I-J-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1687 788 1987 1858	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (I) (INPUT = 0.90)
JSI METAL = 0.44 (G) (INPUT = 1.00)



Structural component only
DWG# T-2007176 92

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T47	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:24 2020 Page 2
ID:K?TPdha0nol1aYdbWlOFzIdaG-sCrkNHl2LVTSZ2WXIn?uxNuSFX8o!iOpivXZmTzNB11

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	4.0	8.0	1.00	3.00
C	TMWW-t	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	8.0	2.25	2.00
E	TMWW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	8.0	2.25	2.00
G	TMWW-t	MT20	5.0	8.0		Edge
H	BMV1-p	MT20	3.0	8.0		
I	BMWW-t	MT20	5.0	8.0	2.50	2.75
J	BMWWW-t	MT20	5.0	8.0		
K	BS-t	MT20	5.0	8.0		
L	BMWW-t	MT20	5.0	8.0		
M	BMWW-t	MT20	5.0	8.0		
N	BMV1-p	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2007176 1/2

JOB NAME 408170	TRUSS NAME T48	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 5 Oct 2019 MTek Industries, Inc. Sat Apr 25 13:02:26 2020 Page 1 ID:K7TPdhgJ0npl1qIYdbWIOFzIdeG-LOP7bdJg8pbJBc6KrUX7UbRc0xZ9U3GzyZH6lvzNB1S	

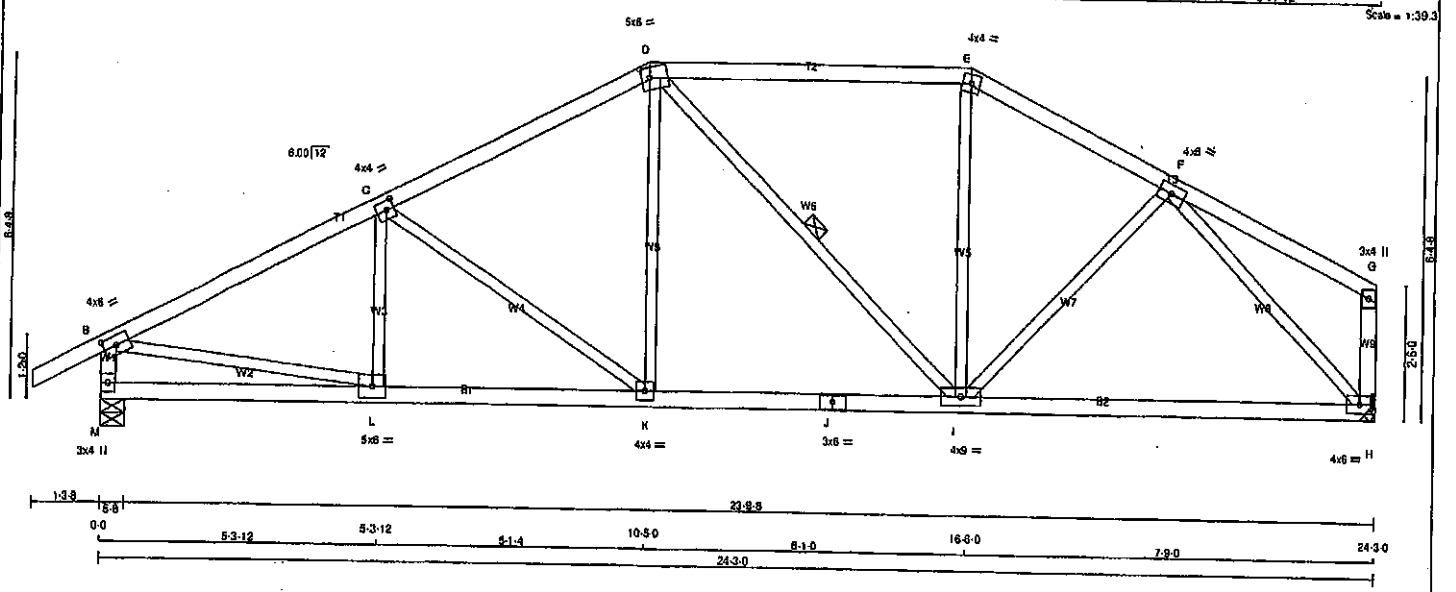

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4 DRY	No.2	SPF
D - E	2x4 DRY	No.2	SPF
E - G	2x4 DRY	No.2	SPF
M - B	2x4 DRY	No.2	SPF
H - G	2x4 DRY	No.2	SPF
M - J	2x4 DRY	No.2	SPF
J - H	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-1	MT20	4.0	8.0	2.00 3.00
C	TMVW-1	MT20	4.0	4.0	2.00 1.75
D	TTWV-m	MT20	5.0	8.0	2.25 2.00
E	TTW-m	MT20	4.0	4.0	
F	TMVW-1	MT20	4.0	8.0	
G	TMVW-1	MT20	3.0	4.0	
H	BMVW-1	MT20	4.0	8.0	
I	BMVW-1	MT20	4.0	8.0	
J	BS-1	MT20	3.0	8.0	
K	BMVW-1	MT20	4.0	4.0	
L	BMVW-1	MT20	5.0	8.0	
M	BMV-1	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
M	1461	0	1461	0	0	5-8			
H	1337	0	1337	0	0	MECHANICAL			

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS							
JT	1ST CASE	2ND CASE	3RD CASE	4TH CASE	5TH CASE	6TH CASE	7TH CASE
M	1031	890 / 0	0 / 0	0 / 0	0 / 0	341 / 0	0 / 0
H	945	620 / 0	0 / 0	0 / 0	0 / 0	325 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-I.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)
FR-TO				FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	L-C	-185 / 32	0.04 (1)	0.04 (1)
B-C	-1844 / 0	-91.8	-91.8 0.36 (1)	C-K	-438 / 0	0.31 (1)	0.31 (1)
C-D	-1488 / 0	-91.8	-91.8 0.34 (1)	K-D	0 / 334	0.08 (1)	0.08 (1)
D-E	-1181 / 0	-91.8	-91.8 0.46 (1)	D-I	-189 / 0	0.09 (1)	0.09 (1)
E-F	-1338 / 0	-91.8	-91.8 0.18 (1)	I-E	0 / 175	0.05 (4)	0.05 (4)
F-G	0 / 18	-91.8	-91.8 0.21 (1)	I-F	0 / 158	0.04 (4)	0.04 (4)
M-B	-1418 / 0	0.0	0.0 0.14 (1)	B-L	0 / 1892	0.38 (1)	0.38 (1)
H-G	-138 / 0	0.0	0.0 0.02 (1)	F-H	-1583 / 0	0.82 (1)	0.82 (1)
M-L	0 / 0	-18.5	-18.5 0.12 (4)				
L-K	0 / 1871	-18.5	-18.5 0.32 (1)				
K-J	0 / 1313	-18.5	-18.5 0.36 (4)				
J-I	0 / 1313	-18.5	-18.5 0.36 (4)				
I-H	0 / 1069	-18.5	-18.5 0.34 (4)				

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.8 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF
SPACING	= 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.81")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.48/1.00 (D-E); BC=0.38/1.00 (I-K); WB=0.82/1.00 (F-H); SS=0.22/1.00 (D-E);

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (8) (INPUT = 0.90)
JSI METAL= 0.50 (8) (INPUT = 1.00)




Structural component only
DWG# T-2007177

Structural component only
DWG# T-2007178

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T50	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:28 2020 Page 1
ID:K?TPdngi0np1qIYdbWOFzldaG-fz5FDILZPkzu2gpJXd4q6D3AB8cJhXEPeXWmvEzNB1P

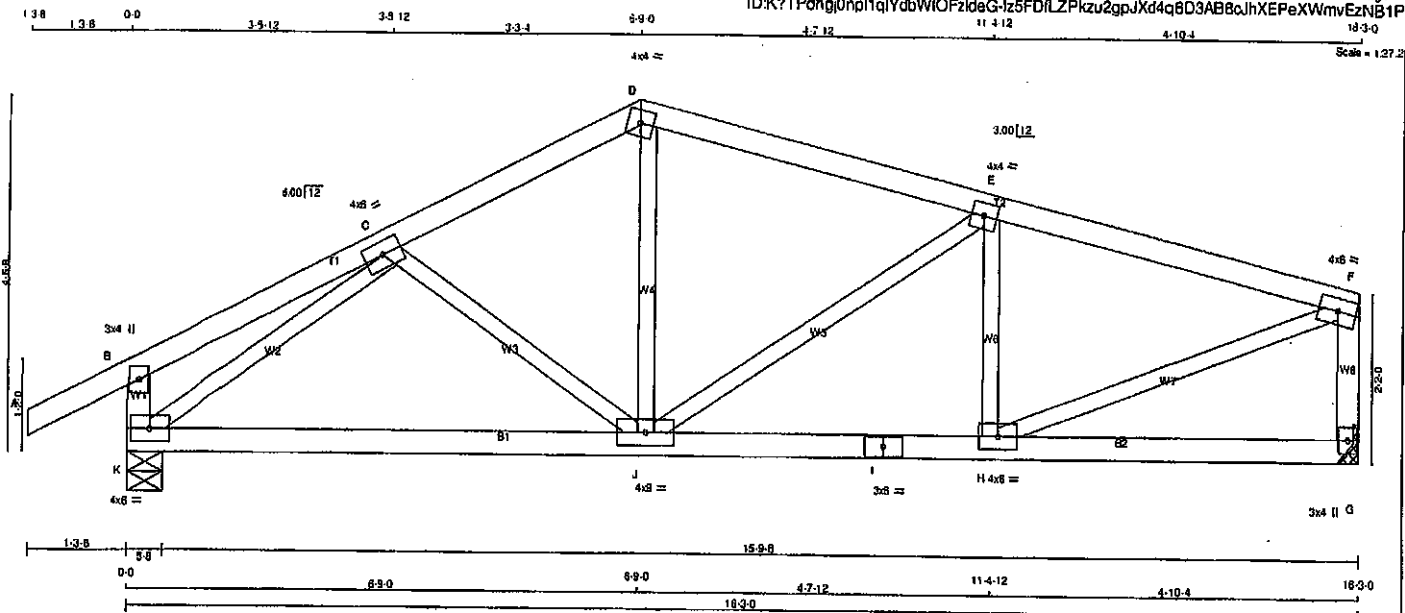

LUMBER	N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS				
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - K	2x4	DRY	No.2	SPF
K - L	2x4	DRY	No.2	SPF
L - M	2x4	DRY	No.2	SPF
M - N	2x4	DRY	No.2	SPF
N - O	2x4	DRY	No.2	SPF
O - P	2x4	DRY	No.2	SPF
P - Q	2x4	DRY	No.2	SPF
Q - R	2x4	DRY	No.2	SPF
R - S	2x4	DRY	No.2	SPF
S - T	2x4	DRY	No.2	SPF
T - U	2x4	DRY	No.2	SPF
U - V	2x4	DRY	No.2	SPF
V - W	2x4	DRY	No.2	SPF
W - X	2x4	DRY	No.2	SPF
X - Y	2x4	DRY	No.2	SPF
Y - Z	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY, SEASONED LUMBER.

PLATES (table is in inches)	PLATES	W	LEN	Y	X
JT	TMV+p	MT20	3.0	4.0	
B	TMVW-1	MT20	4.0	8.0	
C	TMVW-1	MT20	4.0	8.0	
D	TMVW-1	MT20	4.0	8.0	
E	TMVW-1	MT20	4.0	8.0	
F	TMVW-1	MT20	4.0	8.0	
G	BMV1+p	MT20	3.0	4.0	
H	BMVW-1	MT20	4.0	8.0	
I	BS+	MT20	3.0	6.0	
J	BMVW-1	MT20	4.0	8.0	
K	BMVW-1	MT20	4.0	8.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
K	1020	0	1020	0
G	898	0	898	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3'-8".

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW
K	719	485 / 0
G	633	416 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.73 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MEMB.	FORCE	MAX	WEBS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MEMB.	FORCE	MAX
FR-TO									FR-TO								
A-B	0 / 28	-91.8	-91.8	0.12	(1)	10.00	C-J	-135 / 7	0.04	(1)							
B-C	0 / 14	-91.8	-91.8	0.15	(1)	10.00	J-D	0 / 355	0.08	(1)							
C-D	-962 / 0	-91.8	-91.8	0.13	(1)	6.20	J-E	-263 / 0	0.13	(1)							
D-E	-894 / 0	-91.8	-91.8	0.26	(1)	6.18	H-E	-335 / 0	0.07	(1)							
E-F	-1094 / 0	-91.8	-91.8	0.27	(1)	5.73	K-C	-1196 / 0	0.35	(1)							
K-B	-248 / 0	0.0	0.0	0.03	(1)	7.81	H-F	0 / 1150	0.26	(1)							
G-F	-855 / 0	0.0	0.0	0.10	(1)	7.81											
K-J	0 / 966	-18.5	-18.5	0.26	(1)	10.00											
J-I	0 / 1073	-18.5	-18.5	0.27	(1)	10.00											
I-H	0 / 1073	-18.5	-18.5	0.27	(1)	10.00											
H-G	0 / 0	-18.5	-18.5	0.10	(4)	10.00											

TOTAL WEIGHT = 2 X 63 = 126 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/999 (0.09")

CS: TO=0.27/1.00 (E-F:1), BC=0.27/1.00 (H-J:1),

WB=0.35/1.00 (G-K:1), SS=0.21/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618	354
	1667	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.71 (H) (INPUT = 0.90)

JSI METAL= 0.32 (H) (INPUT = 1.00)




Structural component only
DWG# T-2007179

JOB NAME 408170	TRUSS NAME T51	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Sat Apr 26 13:02:29 2020 Page 1
ID:K?TPdngl0npl1qlydbWfOFzldG-D9ldR?MBA25fpOV4Kb3eRbKcYx2QzGZIBFKSg2NB1C

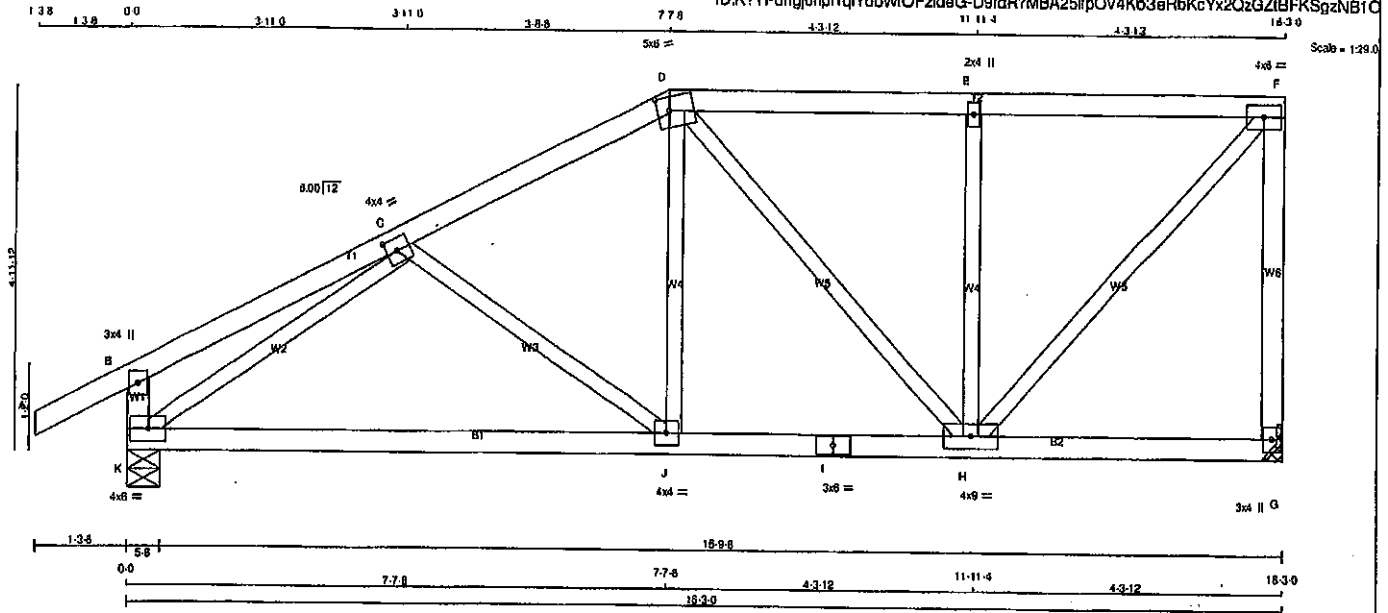

TOTAL WEIGHT = 70 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4 DRY	No.2	SPF
D - F	2x4 DRY	No.2	SPF
G - F	2x4 DRY	No.2	SPF
K - B	2x4 DRY	No.2	SPF
K - I	2x4 DRY	No.2	SPF
I - G	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
C	TMWW-l	MT20	4.0	4.0 2.00 1.75
D	TTWW-m	MT20	5.0	8.0 2.25 2.00
E	TMV+w	MT20	2.0	4.0
F	TMV-w	MT20	4.0	8.0
G	BMV1+p	MT20	3.0	4.0
H	BMVWW-l	MT20	4.0	9.0
I	BS-1	MT20	3.0	8.0
J	BMVW-l	MT20	4.0	4.0
K	BMVW1-l	MT20	4.0	8.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG	BRG	BRG
G	HORIZ	DOWN	HORIZ	UPLIFT	IN-SX	IN-SX	IN-SX
G	898	0	898	0	0	MECHANICAL	
K	1020	0	1020	0	0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
G	833	416 / 0	0 / 0	0 / 0	0 / 0	218 / 0	0 / 0
K	719	485 / 0	0 / 0	0 / 0	0 / 0	234 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.21 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	C-J	-215 / 0	0.08 (1)
B-C	0 / 17	-91.8	-91.8 0.20 (1)	10.00	J-D	0 / 268	0.08 (1)
C-D	-901 / 0	-91.8	-91.8 0.22 (1)	6.21	D-H	-210 / 0	0.14 (1)
D-E	-684 / 0	-91.8	-91.8 0.28 (1)	6.25	H-E	-488 / 0	0.18 (1)
E-F	-654 / 0	-91.8	-91.8 0.28 (1)	6.25	H-F	0 / 961	0.22 (1)
G-F	-858 / 0	0.0	0.0 0.35 (1)	7.81	K-C	-1192 / 0	0.43 (1)
K-B	-281 / 0	0.0	0.0 0.03 (1)	7.81			
K-J	0 / 965	-18.5	-18.5 0.30 (4)	10.00			
J-I	0 / 798	-18.5	-18.5 0.30 (4)	10.00			
I-H	0 / 796	-18.5	-18.5 0.30 (4)	10.00			
H-G	0 / 0	-18.5	-18.5 0.08 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.54")
CALCULATED VERT. DEFL. (LL) = L/989 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.54")
CALCULATED VERT. DEFL. (TL) = L/989 (0.12")

CSI: TC=0.35/1.00 (F-G:1), BC=0.30/1.00 (J-K:4), WB=0.43/1.00 (C-K:1), SS=0.19/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	818	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 6.0 Deg.

JSI GRIP = 0.88 (C) (INPUT = 0.80)
JSI METAL = 0.40 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007180

JOB NAME 408170	TRUSS NAME G52	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:13 2020 Page 1	

ID:K?TPdngj0npl1q|YdbWOFzIdeG-h4ha4W89x740IMAQ9zJ?3xI05YfppiCBiNUlcZNB1e

Scale: 1/2"=1'

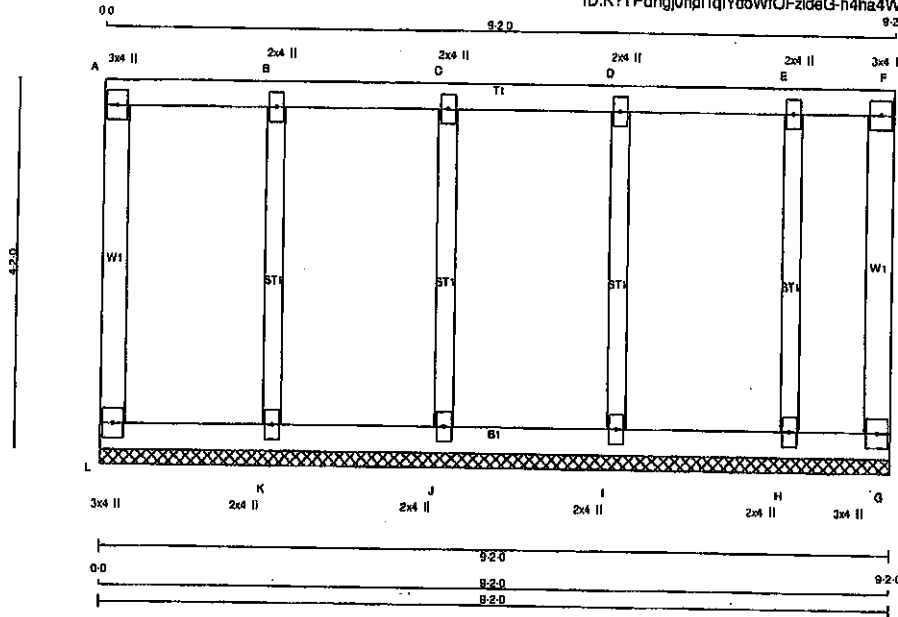

LUMBER			
N. L. G. A. RULES	SIZE	DRY	NO.2
CHORDS	2x4	DRY	No.2
L - A	2x4	DRY	No.2
A - F	2x4	DRY	No.2
G - F	2x4	DRY	No.2
L - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B, C, D, E						
B	TMV+w	MT20	2.0	4.0		
F	TMV+p	MT20	3.0	4.0		
G	BMV1+p	MT20	3.0	4.0		
H, I, J, K						
H	BMV1+w	MT20	2.0	4.0		
L	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

PROVIDE ADEQUATE DRAINAGE TO PREVENT PONDING.

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX (CSI (LC))	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX (CSI (LC))
FR-TO		FROM TO		FR-TO			
L-A	-100 / 0	0.0	0.0 0.02 (1)	7.81	K-B	-245 / 0	0.09 (1)
A-B	-4 / 0	-114.3 -114.3	0.08 (1)	10.00	J-C	-224 / 0	0.08 (1)
B-C	-4 / 0	-114.3 -114.3	0.08 (1)	10.00	I-D	-238 / 0	0.08 (1)
C-D	-4 / 0	-114.3 -114.3	0.07 (1)	10.00	H-E	-186 / 0	0.08 (1)
D-E	-4 / 0	-114.3 -114.3	0.07 (1)	10.00			
E-F	-4 / 0	-114.3 -114.3	0.05 (1)	10.00			
G-F	-54 / 0	0.0	0.0 0.02 (1)	7.81			
L-K	0 / 4	-18.5 -18.5	0.02 (4)	10.00			
K-J	0 / 4	-18.5 -18.5	0.02 (4)	10.00			
J-I	0 / 4	-18.5 -18.5	0.02 (4)	10.00			
I-H	0 / 4	-18.5 -18.5	0.02 (4)	10.00			
H-G	0 / 4	-18.5 -18.5	0.01 (4)	10.00			

TOTAL WEIGHT = 41 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	15.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	48.0	PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 0.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.08/1.00 (B-C:1), BC=0.02/1.00 (J-K:4), WB=0.09/1.00 (B-K:1), SSI=0.13/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00
FLAT ROOF FACTOR = 0.75

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP (DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788	1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.17 (B) (INPUT = 0.90)

JSI METAL = 0.07 (K) (INPUT = 1.00)

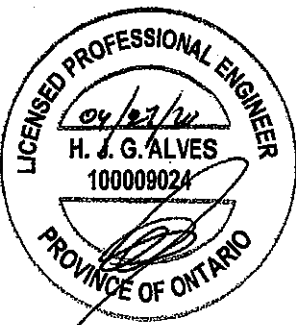


Structural component only
DWG# T-2007166

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T53S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:30 2020 Page 1
ID:K7TPdhgJ0np1tqYdbWIOFzIdaG-hLC0eLNpxLDcHzzh26iBe8YnyLF9WNI5r?1_7zNB1N

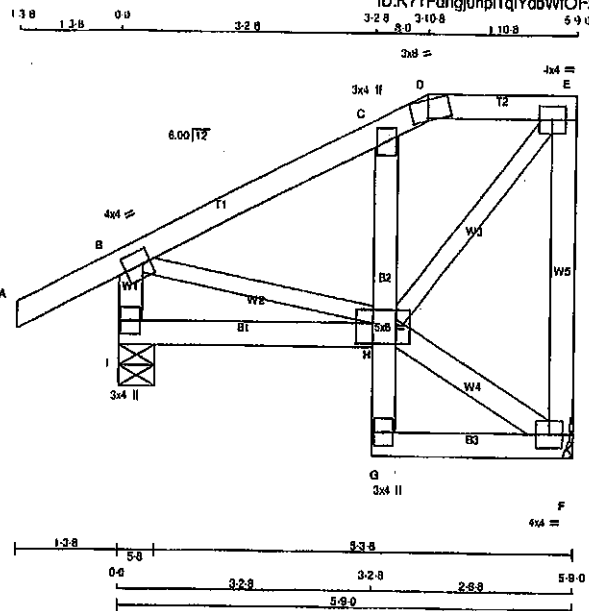

Scale = 1/26.0

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
I - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
G - C	2x4	DRY	No.2
G - F	2x4	DRY	No.2
ALL WEBS	2x4	DRY	No.2
EXCEPT			
B - H	2x3	DRY	No.2
H - E	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
JT	FACTORED GROSS REACTION	VERT	HORZ	MAXIMUM FACTORED GROSS REACTION	DOWN	HORZ	UPLIFT
F	302	0	0	302	0	0	0
I	457	0	0	457	0	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
F	214	138/0	0/0	0/0	0/0	75/0	0/0
I	320	225/0	0/0	0/0	0/0	95/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LBS)	MAX. CS (LBS)
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0/28	-91.8	-91.8 0.12 (1)	10.00	H-F	-10/0	0.00 (1)
B-C	-217/0	-91.8	-91.8 0.14 (1)	8.25	B-H	0/153	0.03 (1)
C-D	-200/0	-91.8	-91.8 0.05 (1)	8.25	H-E	0/247	0.08 (1)
D-E	-167/0	-91.8	-91.8 0.03 (1)	8.25			
F-E	-273/0	0.0	0.0 0.03 (1)	7.81			
I-B	-420/0	0.0	0.0 0.04 (4)	7.81			
I-H	0/41	-18.5	-18.5 0.05 (4)	10.00			
G-H	0/25	0.0	0.0 0.02 (1)	10.00			
H-C	-186/0	0.0	0.0 0.04 (1)	7.81			
G-F	0/18	-18.5	-18.5 0.02 (4)	10.00			

TOTAL WEIGHT = 33.6

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPO 2011, TPO 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEF. (LL) = L/360 (0.19")
CALCULATED VERT. DEF. (LL) = L/999 (0.00")
ALLOWABLE DEF. (TL) = L/360 (0.19")
CALCULATED VERT. DEF. (TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (B-C:1), BC=0.05/1.00 (H-I:4), WB=0.06/1.00 (E-H:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.36 (H) (INPUT = 0.90)
JSI METAL = 0.13 (B) (INPUT = 1.00)

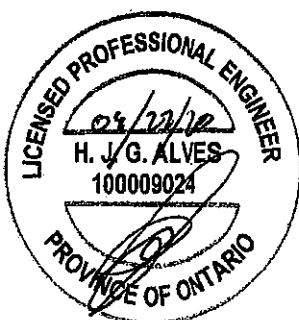


Structural component only
DWG# T-2007181

DRWG NO.

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Sat Apr 25 13:02:31 2020 Page 1
ID:K?TPdhg|Onp|tq|YbWf|Fz|deG-9YmOrgNRh|LTV7Y|C|eXkshknMh|ouyRrK|VhRWZzNB1M

实验 = 121.0

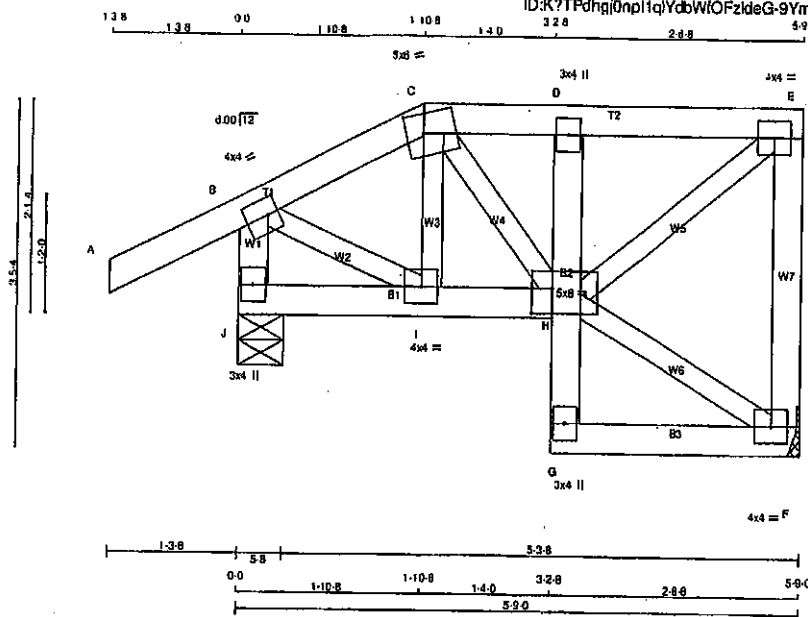

TOTAL WEIGHT = 31 lbs

MAX. FACTORED		FACTORED		MEMB.		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB. FR-TO	FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM	TO				
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00	I-C	-50/10
B-C	-240/0	-91.8	-91.8	0.12 (1)	8.25	C-H	0/84
C-D	-248/0	-91.8	-91.8	0.05 (1)	8.25	H-F	0.02 (1)
D-E	-241/0	-91.8	-91.8	0.07 (1)	6.25	E-G	0.00 (1)
E-F	-278/0	0.0	0.0	0.05 (1)	7.81	F-I	0/302
J-B	-439/0	0.0	0.0	0.04 (1)	7.81	B-I	0/214
J-I	0/0	-18.5	-18.5	0.02 (4)	10.00		
I-H	0/193	-18.5	-18.5	0.04 (1)	10.00		
G-H	0/25	0.0	0.0	0.02 (1)	10.00		
H-D	-219/0	0.0	0.0	0.01 (1)	7.81		
G-F	0/8	-18.5	-18.5	0.03 (4)	10.00		


MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		
F-C	-50 / 10	0.01 (1)
C-H	0 / 84	0.02 (1)
H-F	-9 / 0	0.00 (1)
H-E	0 / 302	0.07 (1)
B-I	0 / 214	0.05 (1)

JSI GRIP= 0.33 (B) (INPUT = 0.90)
JSI METAL= 0.13 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007182

JOB NAME 408170	TRUSS NAME T55	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

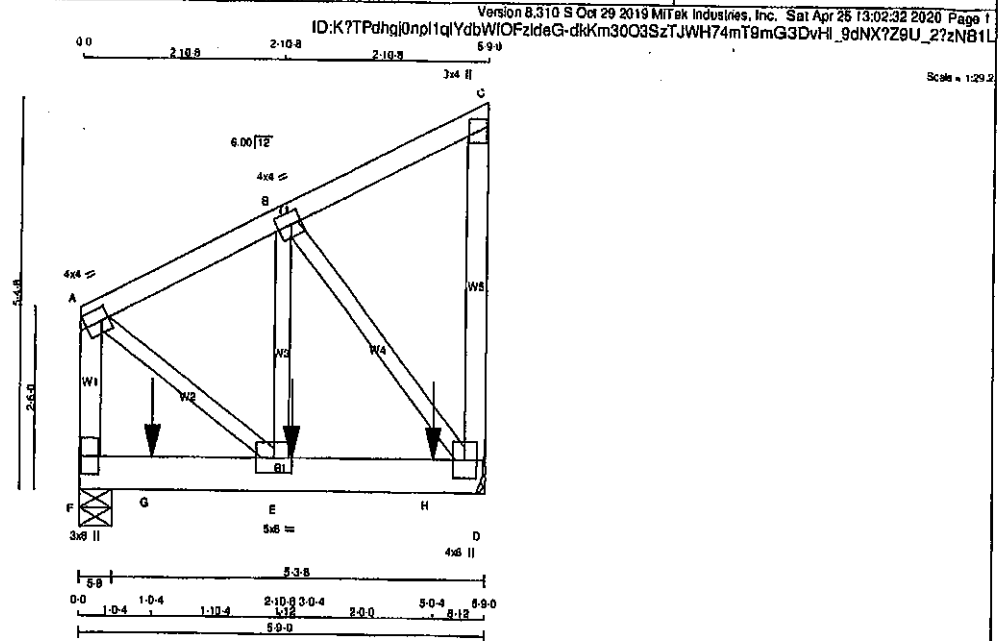

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - A	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
D - C	2x4	DRY	No.2	SPF	
F - D	2x6	DRY	No.2	SPF	
ALL WEBS 2x3 DRY No.2 SPF					
DRY: SEASONED LUMBER.					

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS	#ROWS	SURFACE SPACING (#)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS			
F-A	1	12	TOP
A-C	1	12	TOP
C-D	1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS			
F-D	2	12	SIDE (183.1)
WEBS : (0.122"x3") SPIRAL NAILS			
B-E	1	6	SIDE (45.6)
2x3	1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	4.0	4.0	2.00	1.25
B	TMVW-1	MT20	4.0	4.0	2.00	1.75
C	TMVW-1	MT20	3.0	4.0		
D	BMVW1+p	MT20	4.0	6.0		
E	BMVW-1	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
F	VERT	DOWN	IN-SX	IN-SX
F	1589	0	5-8	5-8
D	1680	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
F	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
F	1121	750/0	0/0	0/0	371/0	0/0
D	1185	792/0	0/0	0/0	394/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX. CSI (LC)	UNBRAC LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED MAX. CSI (LC)
FR-TO						FR-TO			
F-A	-1074/0	0.0	0.0	0.07 (1)	7.81	A-E	0/875	0.12 (1)	
A-B	-867/0	-91.8	-91.8	0.08 (1)	6.25	E-B	0/1044	0.13 (1)	
B-C	-12/0	-91.8	-91.8	0.06 (1)	6.25	B-D	-1248/0	0.21 (1)	
D-C	-105/0	0.0	0.0	0.02 (1)	7.81				
F-G	0/0	-18.5	-18.5	0.19 (1)	10.00				
G-E	0/0	-18.5	-18.5	0.19 (1)	10.00				
E-H	0/788	-16.5	-16.5	0.21 (1)	10.00				
H-D	0/788	-16.5	-16.5	0.21 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	3-0-4	-877	-877		BACK	VERT	TOTAL		C1
G	1-0-4	-877	-877		BACK	VERT	TOTAL		C1
H	5-0-4	-880	-880		BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 34 = 67 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.01")

CSI: TC=0.07/1.00 (A-F:1), BC=0.21/1.00 (D-E:1),
WB=0.21/1.00 (B-D:1), SS=0.20/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.72 (A) (INPUT = 0.90)
JSI METAL= 0.18 (D) (INPUT = 1.00)



Structural component only
DWG# T-20071831/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	T55	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:32 2020 Page 2

ID:K?TPdHgI0np1q/YdbWQFzIdG-dkKm3003SzTJWH74mT9mG3DvHI 9dNX?Z9U 27zNB1L


PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
F	8MVI+p MT20	3.0	8.0		



Structural component only
DWG# T-2007183

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T56	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mike Industries, Inc. Sat Apr 25 13:02:33 2020 Page 1	

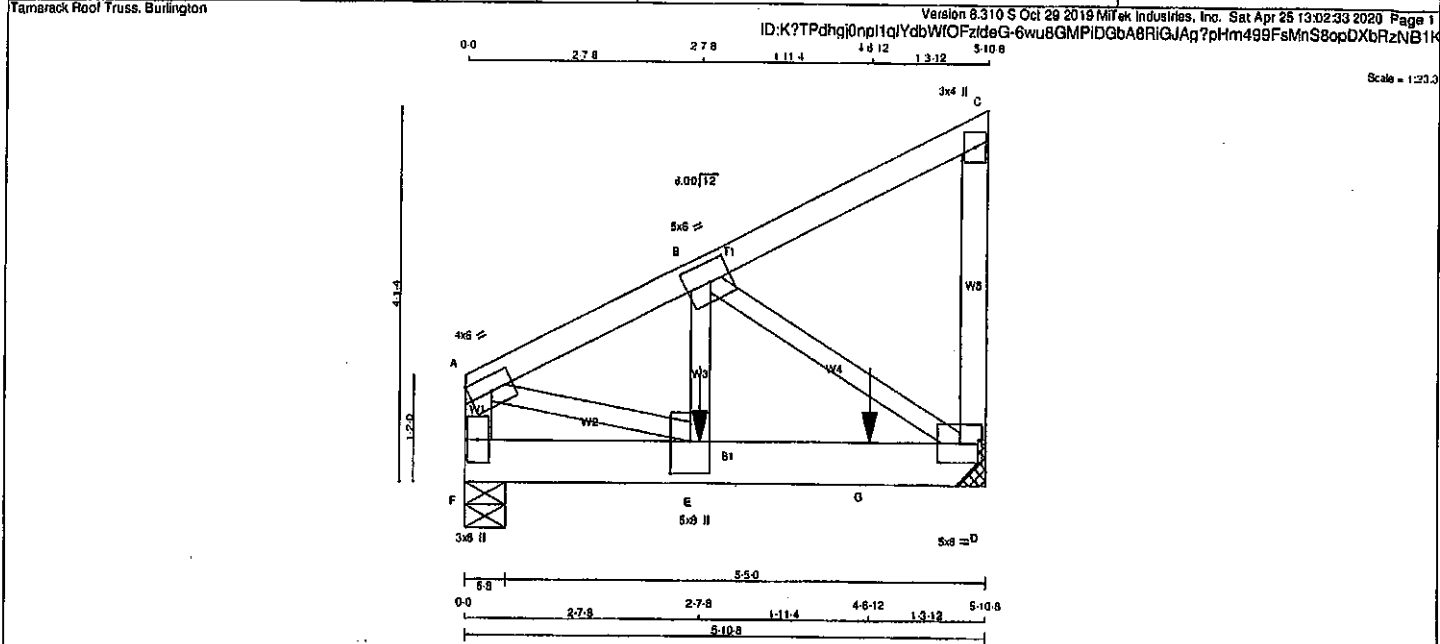

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - A	2x4	DRY	No.2
A - C	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x8	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F - A	12	TOP
A - C	12	TOP
C - D	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D	12	SIDE (949.3)
WEBS : (0.122"x3") SPIRAL NAILS		
B - E	2	SIDE (259.5)
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table in inches)	W	LEN	Y	X
JT TYPE	PLATES			
A	TMW-1	MT20	4.0	8.0
B	TMW-1	MT20	5.0	6.0
C	TMW-1	MT20	3.0	4.0
D	BMW-1	MT20	5.0	6.0
E	BMW-1	MT20	5.0	8.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG	
F	2334	0	2334	0	5-8
D	2733	0	2733	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	
F	1846 1103 / 0 0 / 0 0 / 0 0 / 0 0
D	1929 1280 / 0 0 / 0 0 / 0 0 639 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.20 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED	MEMB.	MAX. FACTORED
FORCE (LBS)	VERT. LOAD (PLF)	FORCE (LBS)	MAX. FACTORED
FR-TO	FROM TO	FR-TO	FROM TO
F-A	-2316 / 0	0.0	0.0 0.13 (1) 7.37
A-B	-3101 / 0	-91.8	-91.8 0.08 (1) 5.20
B-C	-5 / 0	-91.8	-91.8 0.08 (1) 10.00
D-C	-138 / 0	0.0	0.0 0.02 (1) 7.81
F-E	0 / 0	-18.5	-18.5 0.01 (4) 10.00
E-G	0 / 2779	-18.5	-18.5 0.57 (1) 10.00
G-D	0 / 2779	-18.5	-18.5 0.57 (1) 10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	2-7-8	-3101	-3101	---	BACK	VERT	TOTAL	---	C1
G	4-8-12	-1318	-1318	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 29 = 57 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/988 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.04")

CSI: TO=0.13/1.00 (A-F:1), BC=0.57/1.00 (D-E:1), WB=0.42/1.00 (B-D:1), SSI=0.27/1.00 (D-E:1)

DOM LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 768 1937 1696

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (E) (INPUT = 0.90)
JSI METAL = 0.50 (E) (INPUT = 1.00)



Structural component only
DWG# T-2007184 1/2

CONTINUED ON PAGE 2


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	T56	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 13:02:33 2020 Page 2		ID:K?TPdhg0npl1qYdbWIOFzidaG-6wu8GMPIDGbA8RiGJAg?plm499FgMnS8opDXbHzNB1K	

Version 8.310 S Oct 29 2019 Mitak Industries, Inc. Sat Apr 25 13:02:33 2020 Page 2

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
F	BMV1+p	MT20	3.0	6.0	


Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

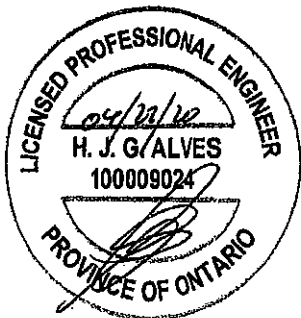


Structural component only
DWG# T-2007184 4/2

JOB NAME 408168	TRUSS NAME PB1	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:46 2020 Page 1
 ID:DMCubINVR6TstFoe31v6l_zns11-PDfyPME2p5aIfmuAaG4kD6h8P9Gw?nTyvpaZzNBRN

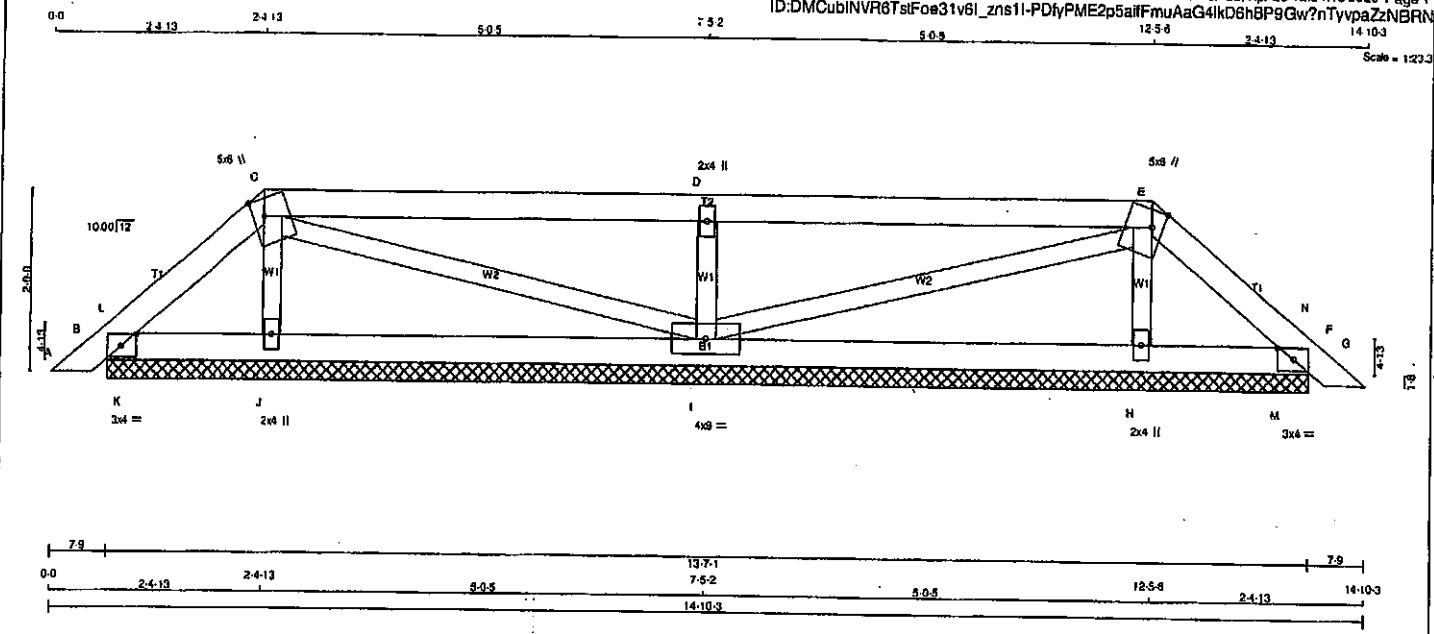

JOB NAME 408168	TRUSS NAME J1	QUANTITY 19	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 12:34:43 2020 Page 1			
		ID:DMCubINVR6TstFoe31v6L_2ns11-7a_pnkBAWAG7oo1JURIN76ba9zNy3aYKn_h9zEzNBRO			

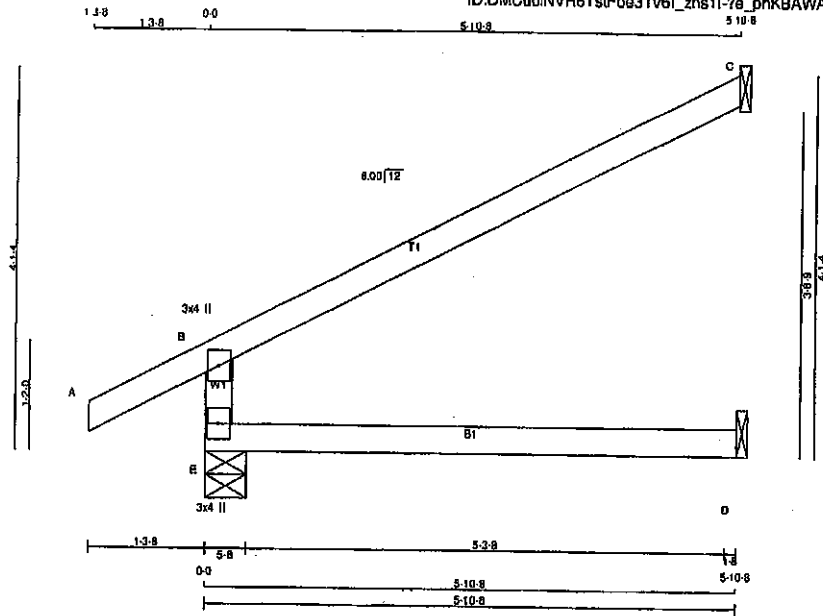

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
E	BMV+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
GROSS REACTION		GROSS REACTION		BRG	BRG	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	525	0	525	0	0	5-8	5-8
C	202	0	202	0	0	1-8	1-8
D	45	0	50	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	389	287/0	0/0	0/0	0/0	111/0	0/0
C	139	113/0	0/0	0/0	0/0	28/0	0/0
D	38	0/0	0/0	0/0	0/0	38/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED				WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1	MAX	MAX	MEMB.	FORCE (LBS)	MAX	MAX
		FROM TO		CSI (LC)	UNBRAC LENGTH				
FR-TO						FR-TO			
E-B	-461/0	0.0	0.0	0.13 (4)	7.81				
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00				
B-C	-30/0	-91.8	-91.8	0.54 (1)	6.25				
E-D	0/0	-18.5	-18.5	0.13 (4)	10.00				

TOTAL WEIGHT = 19 X 17 = 319 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
DL =	6.0	PSF	
BOT CH.	LL =	0.0	PSF
DL =	7.4	PSF	
TOTAL LOAD =	39.0	PSF	

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (N/A:0), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (E) (INPUT = 0.90)

JSI METAL = 0.13 (E) (INPUT = 1.00)

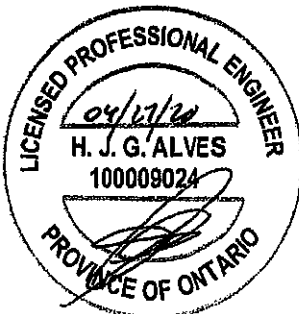


Structural component only
DWG# T-2007126



JOB NAME 408170	TRUSS NAME J40	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:14 2020 Page 1
ID:K?TPdhqj0npl1qIYdbWfOFZkdeG-9GFyHsAniRCIMWichqYYGUjuVsSPHGLQM61Q2zNB1c

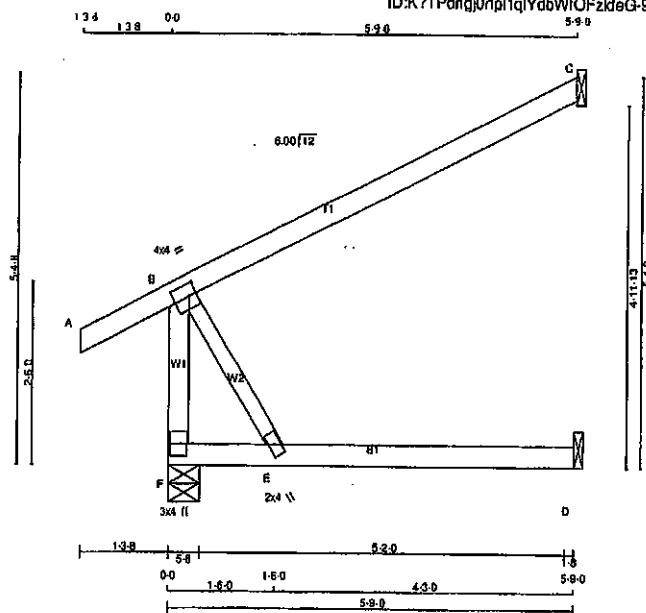

Scale = 1:20.2

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES				
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
ORY: SEASONED LUMBER.				

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
8	TMW-1	MT20	4.0	4.0	200	1.25
E	BMW+u	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
F	441	0	441	0	0	5-8	5-8		
C	264	0	264	0	0	1-8	1-8		
D	63	0	60	0	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B97781H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	310	217/0	0/0	0/0	0/0	93/0	0/0
C	182	147/0	0/0	0/0	0/0	35/0	0/0
D	43	0/0	0/0	0/0	0/0	43/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED FORCE		FACTORED VERT. LOAD LC1		MAX. FACTORED FORCE		WEBS	
MEMB.	FORCE (LBS)	FROM TO	PLF	CSI (LC)	UNBRAC LENGTH	FR-TO	MEMB.	FORCE (LBS)	MAX. FACTORED FORCE
F-B	-388/0	0.0	0.0	0.05 (1)	7.81		B-E	0/0	0.00 (1)
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00				
B-C	0/0	-91.8	-91.8	0.52 (1)	10.00				
F-E	0/0	-18.5	-18.5	0.14 (4)	10.00				
E-D	0/0	-18.5	-18.5	0.18 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
ROT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA D88-08, CSA D88-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.52/1.00 (B-C:1), BC=0.18/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.24 (B) (INPUT = 0.80)
JSI METAL=0.07 (B) (INPUT = 1.00)

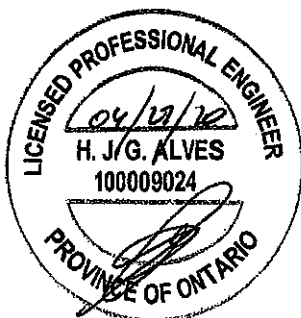


Structural component only
DWG# T-2007167

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408170	C40	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:08 2020 Page 1
ID:K?TPdngj0npl1qYcbWfOfzIdeG-K7h1p806bSjebITMQ8i?Emz4pp?ZnT2GjIC0zNB1

Scale = 1:17.9

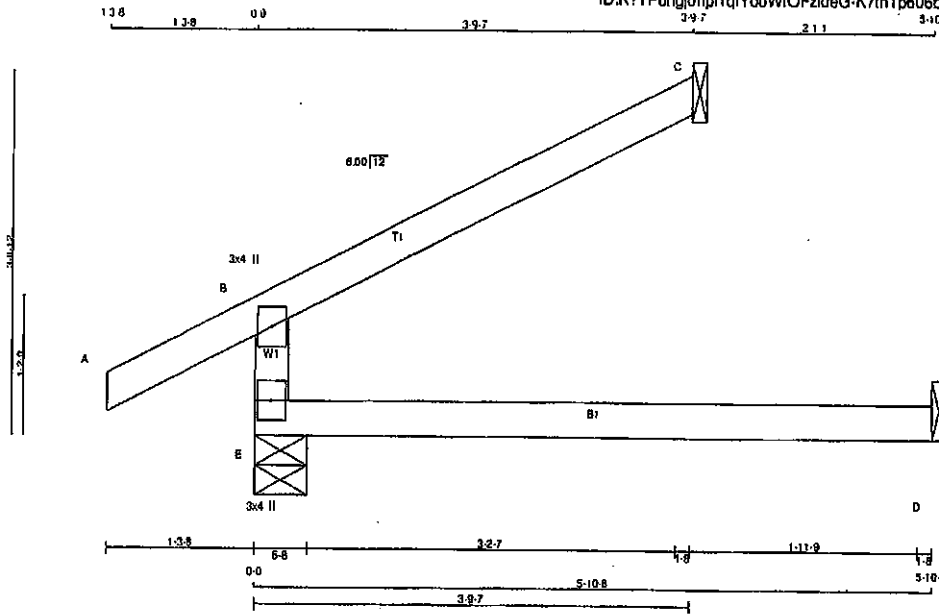

TOTAL WEIGHT = 3 X 14 = 42 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
E	405	0	0	405	0	0	5-8	5-8	5-8
C	130	0	0	130	0	0	1-8	1-8	1-8
D	45	0	0	50	0	0	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	286	190 / 0	0 / 0	0 / 0	0 / 0	96 / 0	0 / 0
C	90	73 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	38	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WESS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	LC1 MAX (PLF)	MAX. CS1 (LC)	UNBRACED LENGTH	MEMB. FORCE (LBS)	MAX. CS1 (LC)
FR-TO							
E-B	-342 / 0	0.0	0.0	0.13 (4)	7.81		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00		
B-C	-19 / 0	-91.8	-91.8	0.22 (1)	6.25		
E-D	0 / 0	-18.5	-18.5	0.13 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(95 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = U/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = U/999 (0.03")

CSI: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (N/A:0), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(FL)
MAX MIN	MAX MIN	MAX MIN
MT20	618	354
	1687	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (E) (INPUT = 0.80)
JSI METAL= 0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007162

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408170	C41	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:09 2020 Page 1					
ID:K?TPdhgJ0npl1qYdbWOFzIdeG-pjR3E96etvaaGltfw7ENrDmzIU9yk01cG4PGkrzNB1i					
Scale = 1:12.1					

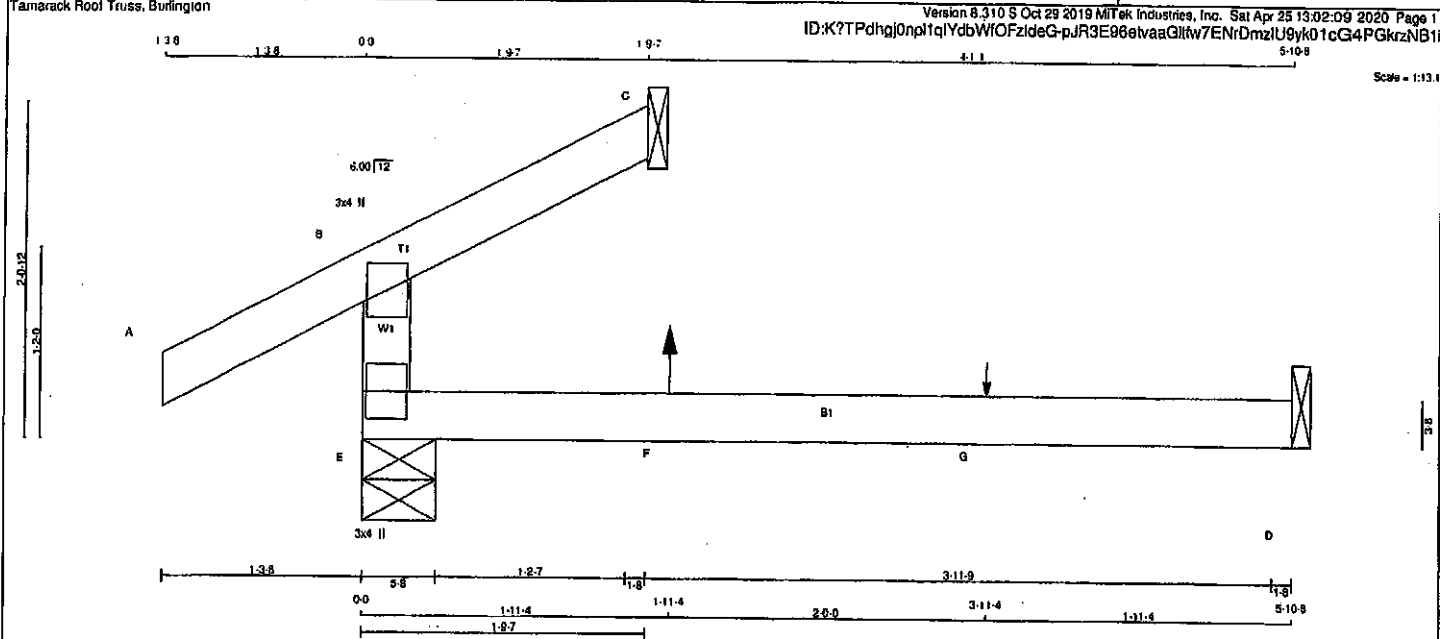

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS	2x4	DRY	No.2
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (tab/a in inches)			
JT TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0 4.0
E	BMV1+p	MT20	3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED	MAXIMUM FACTORED		INPUT	REQD		
	GROSS REACTION	GROSS REACTION		BRG	BRG		
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	284	0	284	0	0	5-8	5-8
C	63	0	63	0	0	1-8	1-8
D	44	0	52	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	200	137/0	0/0	0/0	0/0	62/0	0/0
C	48	21/0	0/0	0/0	0/0	25/0	0/0
D	35	0/-3	0/0	0/0	0/0	37/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (7)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD LC1 MAX	MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD LC1 MAX
	FORCE (LBS)	(PLF)	CSI (LC)		FORCE (LBS)	(PLF)	CSI (LC)
FR-TO	FROM	TO	UNBRACED LENGTH	FR-TO	FROM	TO	UNBRACED LENGTH
E-B	-227/0	0.0	0.0 0.11 (4)	7.81			
A-B	0/28	-91.8	-91.8 0.12 (1)	10.00			
B-C	0/9	-91.8	-91.8 0.08 (4)	10.00			
E-F	0/0	-18.5	-18.5 0.14 (4)	10.00			
F-G	0/0	-18.5	-18.5 0.14 (4)	10.00			
G-D	0/0	-18.5	-18.5 0.14 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE
F	1-11-4	7	1	12	BACK	VERT	TOTAL
G	3-11-4	1	1	12	BACK	VERT	TOTAL

CONNECTION REQUIREMENTS

- C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:		
TOP CH. LL	=	25.6 PSF
DL	=	6.0 PSF
BOT CH. LL	=	0.0 PSF
DL	=	7.4 PSF
TOTAL LOAD	=	39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/899 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/899 (0.04")

CSI: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SS=0.09/1.00 (A-B:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

MAIL VALUES			
PLATE GRIP(DRY) SHEAR	SECTION	(PSI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007163

JOB NAME 408170	TRUSS NAME C42	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Sat Apr 25 13:02:10 2020 Page 1
ID:K?TPdHgJ0npl1qYdbWIOFzIdeG-HV?SRV7GeCIRuvRrTicNQJ6SuW4TTHmV8pHHzNB1h

Scale = 1/16"

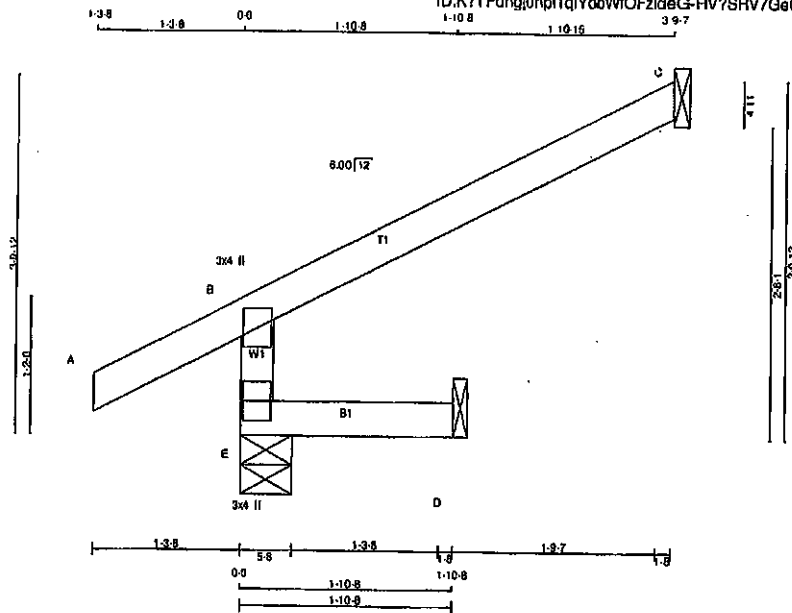

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT		REQD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX	BRG
E	381	0	381	0	0	5-8	5-8	5-8	5-8
C	130	0	130	0	0	1-8	1-8	1-8	1-8
D	16	0	17	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97781H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	250	190/0	0/0	0/0	0/0	60/0	0/0
C	90	73/0	0/0	0/0	0/0	17/0	0/0
D	12	0/0	0/0	0/0	0/0	12/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO		FR-TO			
E-B	-342/0	0.0	0.0	0.01 (4)			
A-B	0/28	-91.8	-91.8	0.13 (5)			
B-C	-19/0	-91.8	-91.8	0.22 (1)			
E-D	0/0	-18.5	-18.5	0.02 (4)			
				10.00			
				6.25			
				10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 10 = 29 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOY CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(66% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.18")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.18")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (A-B:0), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1067 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.14 (E) (INPUT = 0.90)
JSI METAL=0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007164

Tamarack Roof Truss, Burlington



TOTAL WEIGHT = $3 \times 7 = 21$ lb

SPECIFIED LOADS:

TOP CH.	LL =	26.8	PSF
	OL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	OL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/380$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5),
WB=0.00/1.00 (n/a:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	{PSI}		{PLI}		{PLI}
	MAX	MIN	MAX	MIN	MAX MIN
MT20	818	354	1667	788	1987 1858

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

~~PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT~~
~~PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS FACTORED UPLIFT~~

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERMLIVE	WIND	DEAD	SOIL
E	188	141/0	0/0	0/0	0/0	47/0	0/0
C	31	247/18	0/0	0/0	0/0	7/0	0/0
D	7	0/8	0/0	0/0	0/0	12/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E. C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS					WEBBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LOAD LCI	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB. FR-TO	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO							
E-B	-244 / 0	0.0	0.0	0.04 (5)	7.81				
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00				
B-C	-17 / 0	-91.8	-91.8	0.08 (1)	8.25				
E-D	0 / 0	-18.5	-18.5	0.04 (5)	10.00				

~~CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN~~



Structural component only
DWG# T-2007165

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.


Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.

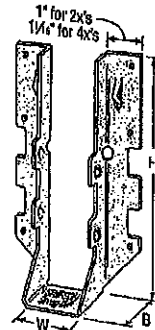


LUS28




LU26L

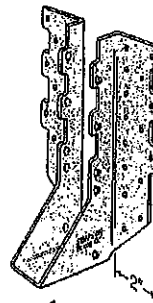

HUS210
(HUS26, HUS28,
and HHUS similar)



HGUS28-2



HHUS210-2



Double-Shear
Nailing
Top View





Double-Shear
Nailing
Side View;
Do not bend tab



Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,580

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

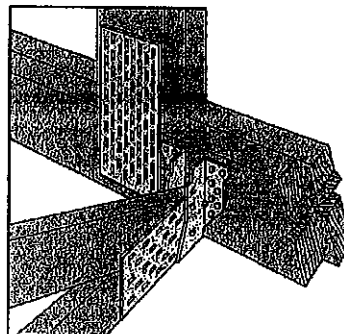

LJS26DS

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options information on pp. 125–127.


HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value

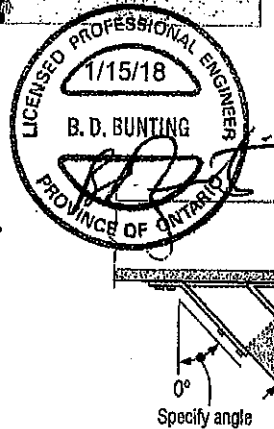

**Top View HHUS Hanger
Skewed Right**
(Joist must be bevel cut)
All joist nails installed on the
outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ¹	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN	(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN
Single 2x Sizes											
LUS24	18	1 1/8	3 1/4	1 1/4	2 1/4	(4) 10d	(2) 10d	710 3.16	1625 7.23	645 2.87	1155 5.14
LU24L	22	1 1/8	3	1 1/4	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360 1.60	1020 4.54	320 1.42	725 3.22
LU26L	22	1 1/8	5	1 1/4	4 1/4	(6) 10d	(4) 10d x 1 1/2"	720 3.20	1605 7.14	645 2.87	1140 5.07
LUS26	18	1 1/8	4 1/4	1 1/4	3 3/4	(4) 10d	(4) 10d	1420 6.32	2170 9.65	1290 5.74	1630 7.25
HUS26	16	1 1/8	5 1/4	3	3 1/8	(14) 16d	(8) 16d	2705 11.90	4940 21.97	2085 9.20	3875 17.24
LJS26DS	18	1 1/8	5	3 1/2	4 1/4	(16) 16d	(6) 16d	2055 9.14	4265 18.97	1460 6.49	4115 18.31
HGUS26	12	1 1/8	5 1/4	5	4 1/4	(20) 16d	(8) 16d	2685 11.96	6625 29.51	2685 11.96	5700 25.35
LU28L	20	1 1/8	6 1/4	1 1/4	5 1/4	(8) 10d	(6) 10d x 1 1/2"	1140 5.07	2185 9.72	1020 4.54	1550 6.89
LUS28	18	1 1/8	6 1/4	1 1/4	3 3/4	(6) 10d	(4) 10d	1420 6.32	2520 11.21	1290 5.74	1790 7.96
HUS28	16	1 1/8	7 1/4	3	6 1/8	(22) 18d	(8) 18d	3805 16.04	5365 23.86	2675 11.90	4345 19.33
HGUS28	12	1 1/8	7 1/4	5	6 1/4	(36) 16d	(12) 16d	3310 14.74	7675 34.19	3310 14.74	6900 30.73
LU210L	20	1 1/8	8	1 1/4	7 1/4	(10) 10d	(6) 10d x 1 1/2"	1140 5.07	2495 11.10	1020 4.54	1770 7.87
LUS210	18	1 1/8	7 1/4	1 1/4	3 3/4	(8) 10d	(4) 10d	1420 6.32	2785 12.39	1290 5.74	2210 9.83

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 3/4" long. See pp. 27–28 for other nail sizes and information.


Face-Mount Hangers

SIMPSON
Strong-Tie

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _o ³	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.16)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
								lb.	lb.	lb.	lb.
								kN	kN	kN	kN
Double 2x Sizes											
LUS24-2	18	3 3/8	3 3/8	2	1 1/2	(4) 16d	(2) 16d	835	2020	590	1435
SS LUS26-2	18	3 3/8	4 3/8	2	4	(4) 16d	(4) 16d	3.71	8.88	2.62	6.38
								1720	2595	1545	1920
HHUS26-2	14	3 3/8	5 3/8	3	3 3/8	(14) 16d	(6) 16d	7.65	11.54	6.87	8.54
								2540	7335	2065	5205
HGUS26-2	12	3 3/8	5 3/8	4	4 1/2	(20) 16d	(8) 16d	12.68	32.83	9.20	23.15
								4385	8950	3110	6355
SS LUS28-2	18	3 3/8	7	2	4	(6) 16d	(4) 16d	19.51	39.81	13.83	28.27
								1720	3325	1545	2675
HHUS28-2	14	3 3/8	7 3/8	3	6 3/8	(22) 16d	(8) 16d	7.65	14.79	6.87	11.45
								3765	8940	2675	6345
HGUS28-2	12	3 3/8	7 3/8	4	8 3/8	(36) 16d	(12) 16d	16.75	39.77	11.90	28.22
								6070	12980	4310	9215
SS LUS210-2	18	3 3/8	9	2	6	(8) 16d	(6) 16d	27.00	57.74	19.17	40.99
								2680	4500	2320	3195
HHUS210-2	14	3 3/8	9 3/8	3	8	(30) 16d	(10) 16d	11.48	20.02	10.32	14.21
								4670	9660	4235	7000
HGUS210-2	12	3 3/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	20.77	42.97	18.84	31.14
								6840	14015	4855	10270
								30.43	62.34	21.80	45.69
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/8	4	4 3/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-3	12	4 1/8	7 1/8	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-3	14	4 1/8	9	3	7 3/8	(30) 16d	(10) 16d	4670	9660	4235	6865
								20.77	43.02	19.84	30.54
HGUS210-3	12	4 1/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.80	46.28
Quadruple 2x Sizes											
HGUS28-4	12	6 3/8	5 3/8	4	4 3/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-4	12	6 3/8	7 3/8	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-4	14	6 3/8	8 3/8	3	7 3/8	(30) 16d	(10) 16d	4670	10155	4235	7210
								20.77	45.17	18.84	32.07
HGUS210-4	12	6 3/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.80	46.28
HGUS212-4	12	6 3/8	10 3/8	4	10 3/8	(56) 16d	(20) 16d	7640	14995	5425	10645
								33.98	66.70	24.13	47.35
HGUS214-4	12	6 3/8	12 3/8	4	11 3/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80
4x Sizes											
LUS46	18	3 3/8	4 3/8	2	3 3/8	(4) 16d	(4) 16d	1720	2595	1545	1920
								7.65	11.54	6.87	8.54
HHUS46	14	3 3/8	5 3/8	3	3 3/8	(14) 16d	(6) 16d	2540	7335	2065	5205
								11.30	32.83	9.20	23.15
HGUS46	12	3 3/8	5 3/8	4	4 3/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
LUS48	18	3 3/8	6 3/8	2	3 3/8	(6) 16d	(4) 16d	1720	3325	1545	2675
								7.65	14.79	6.87	11.45
HHUS48	14	3 3/8	7 3/8	3	6 3/8	(22) 16d	(8) 16d	3765	8940	2675	6345
								16.75	39.77	11.90	28.22
HGUS48	12	3 3/8	7 3/8	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
LUS410	18	3 3/8	8 3/8	2	5 3/8	(8) 16d	(6) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HGUS410	12	3 3/8	9	4	8 3/8	(46) 16d	(16) 16d	6840	14015	4855	10270
								30.43	62.34	21.80	45.69
HGUS412	12	3 3/8	10 3/8	4	10 3/8	(56) 16d	(20) 16d	7640	14995	5425	10645
								33.98	66.70	24.13	47.35
HGUS414	12	3 3/8	12 3/8	4	11 3/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80



Plated Truss Connectors

See footnotes
on p. 268.

SIMPSON
Strong-Tie

A circular professional engineer seal for the Province of Ontario. The outer ring contains the text "LICENSED PROFESSIONAL ENGINEER" at the top and "PROVINCE OF ONTARIO" at the bottom. In the center, the date "4/3/2017" is stamped in an oval, followed by the name "B. D. BUNTING" in bold capital letters. Below the name is a stylized signature or set of initials.

TIME
STATES
DESIGN

(800) 999-5099
stronglie.com

H/TSP

SIMPSON
Strong-Tie

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_D = 1.15$)					
		To Rafters/ Truss	To Plates	To Studs	D.Fir-L			S-P-F		
					Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(6) 8d x 1 1/2"	(4) 8d	—	740	885	300	680	485	215
					3.29	3.05	1.33	3.02	2.16	0.98
SS H2A	18	(5) 8d x 1 1/2"	(2) 8d x 1 1/2"	(5) 8d x 1 1/2"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
					3.58	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	180	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	265	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ⁹	18	(6) 10d x 1 1/2"	(5) 10d x 1 1/2"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A ⁹	18	(9) 10d x 1 1/2"	(9) 10d x 1 1/2"	—	1735	795	410	1505	585	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1 1/2"	(9) 10d x 1 1/2"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1 1/2"	(9) 10d x 1 1/2"	—	1895	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^{7,8}	18	(8) 8d x 1 1/2"	(8) 8d x 1 1/2"	(8) 8d	1465	795	316	1040	585	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2 1/2"	(6) 16d x 2 1/2"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1 1/2"	(13) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
		[2] (12) 8d x 1 1/2"	(15) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
TSP	18	(9) 10d x 1 1/2"	(6) 10d x 1 1/2"	—	1295	440	—	920	310	—
					5.76	1.96	—	4.09	1.38	—
		(9) 10d x 1 1/2"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.98	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2 1/2" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 8/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1 1/2" nails into the top plates and (3) 8d x 1 1/2" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2 1/2" = 0.162" dia. x 2 1/2" long, 10d = 0.148" dia. x 3" long, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long, 8d = 0.131" dia. x 2 1/2" long, 8d x 1 1/2" = 0.131" dia. x 1 1/2" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

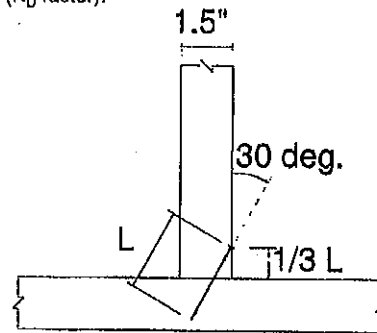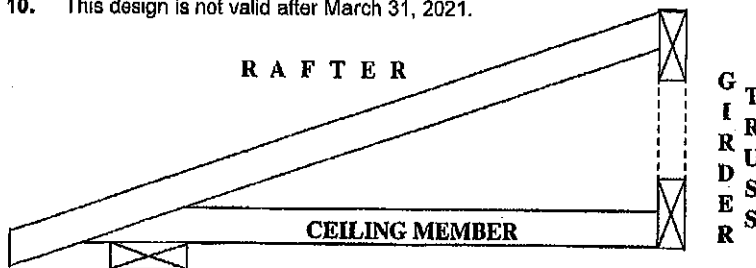


TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

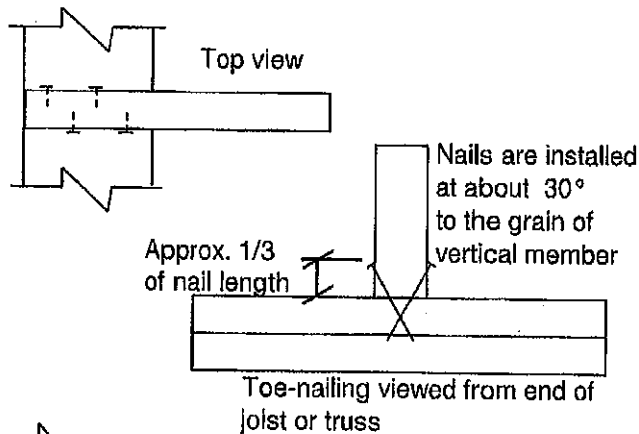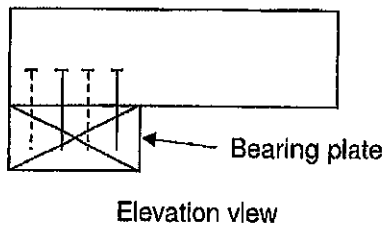

Toe-nailing on 2x4 Bearing Plate

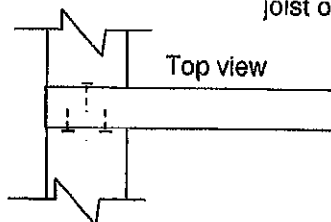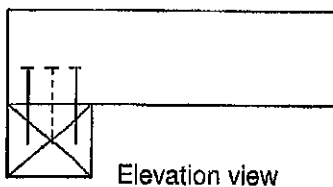


MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/4\" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

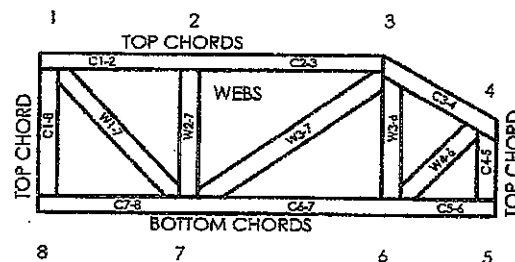

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MII-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected ovetop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

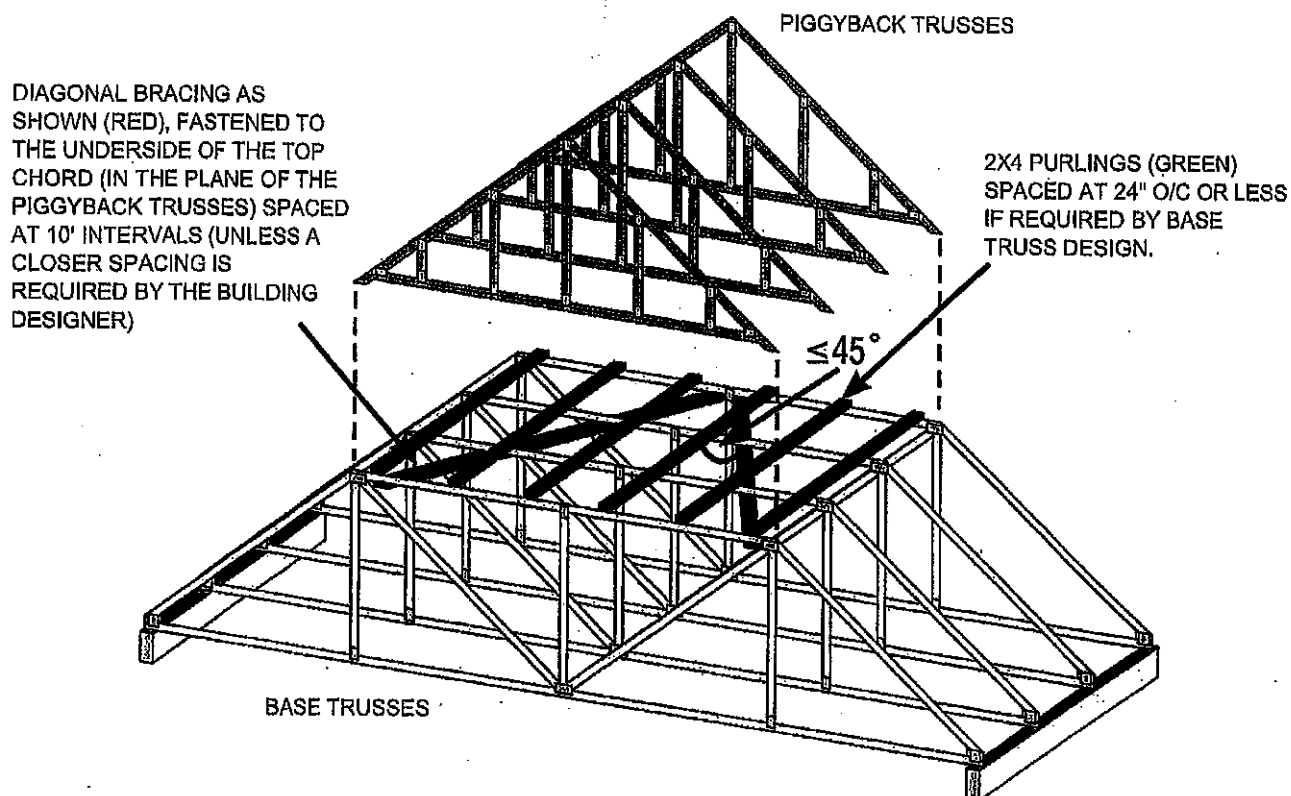


NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufacturer's responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1900213

Feb 09, 2018