


CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department

MAR 5 2021

REC'D BY _____ DATE _____
REF'D TO _____ DATE _____

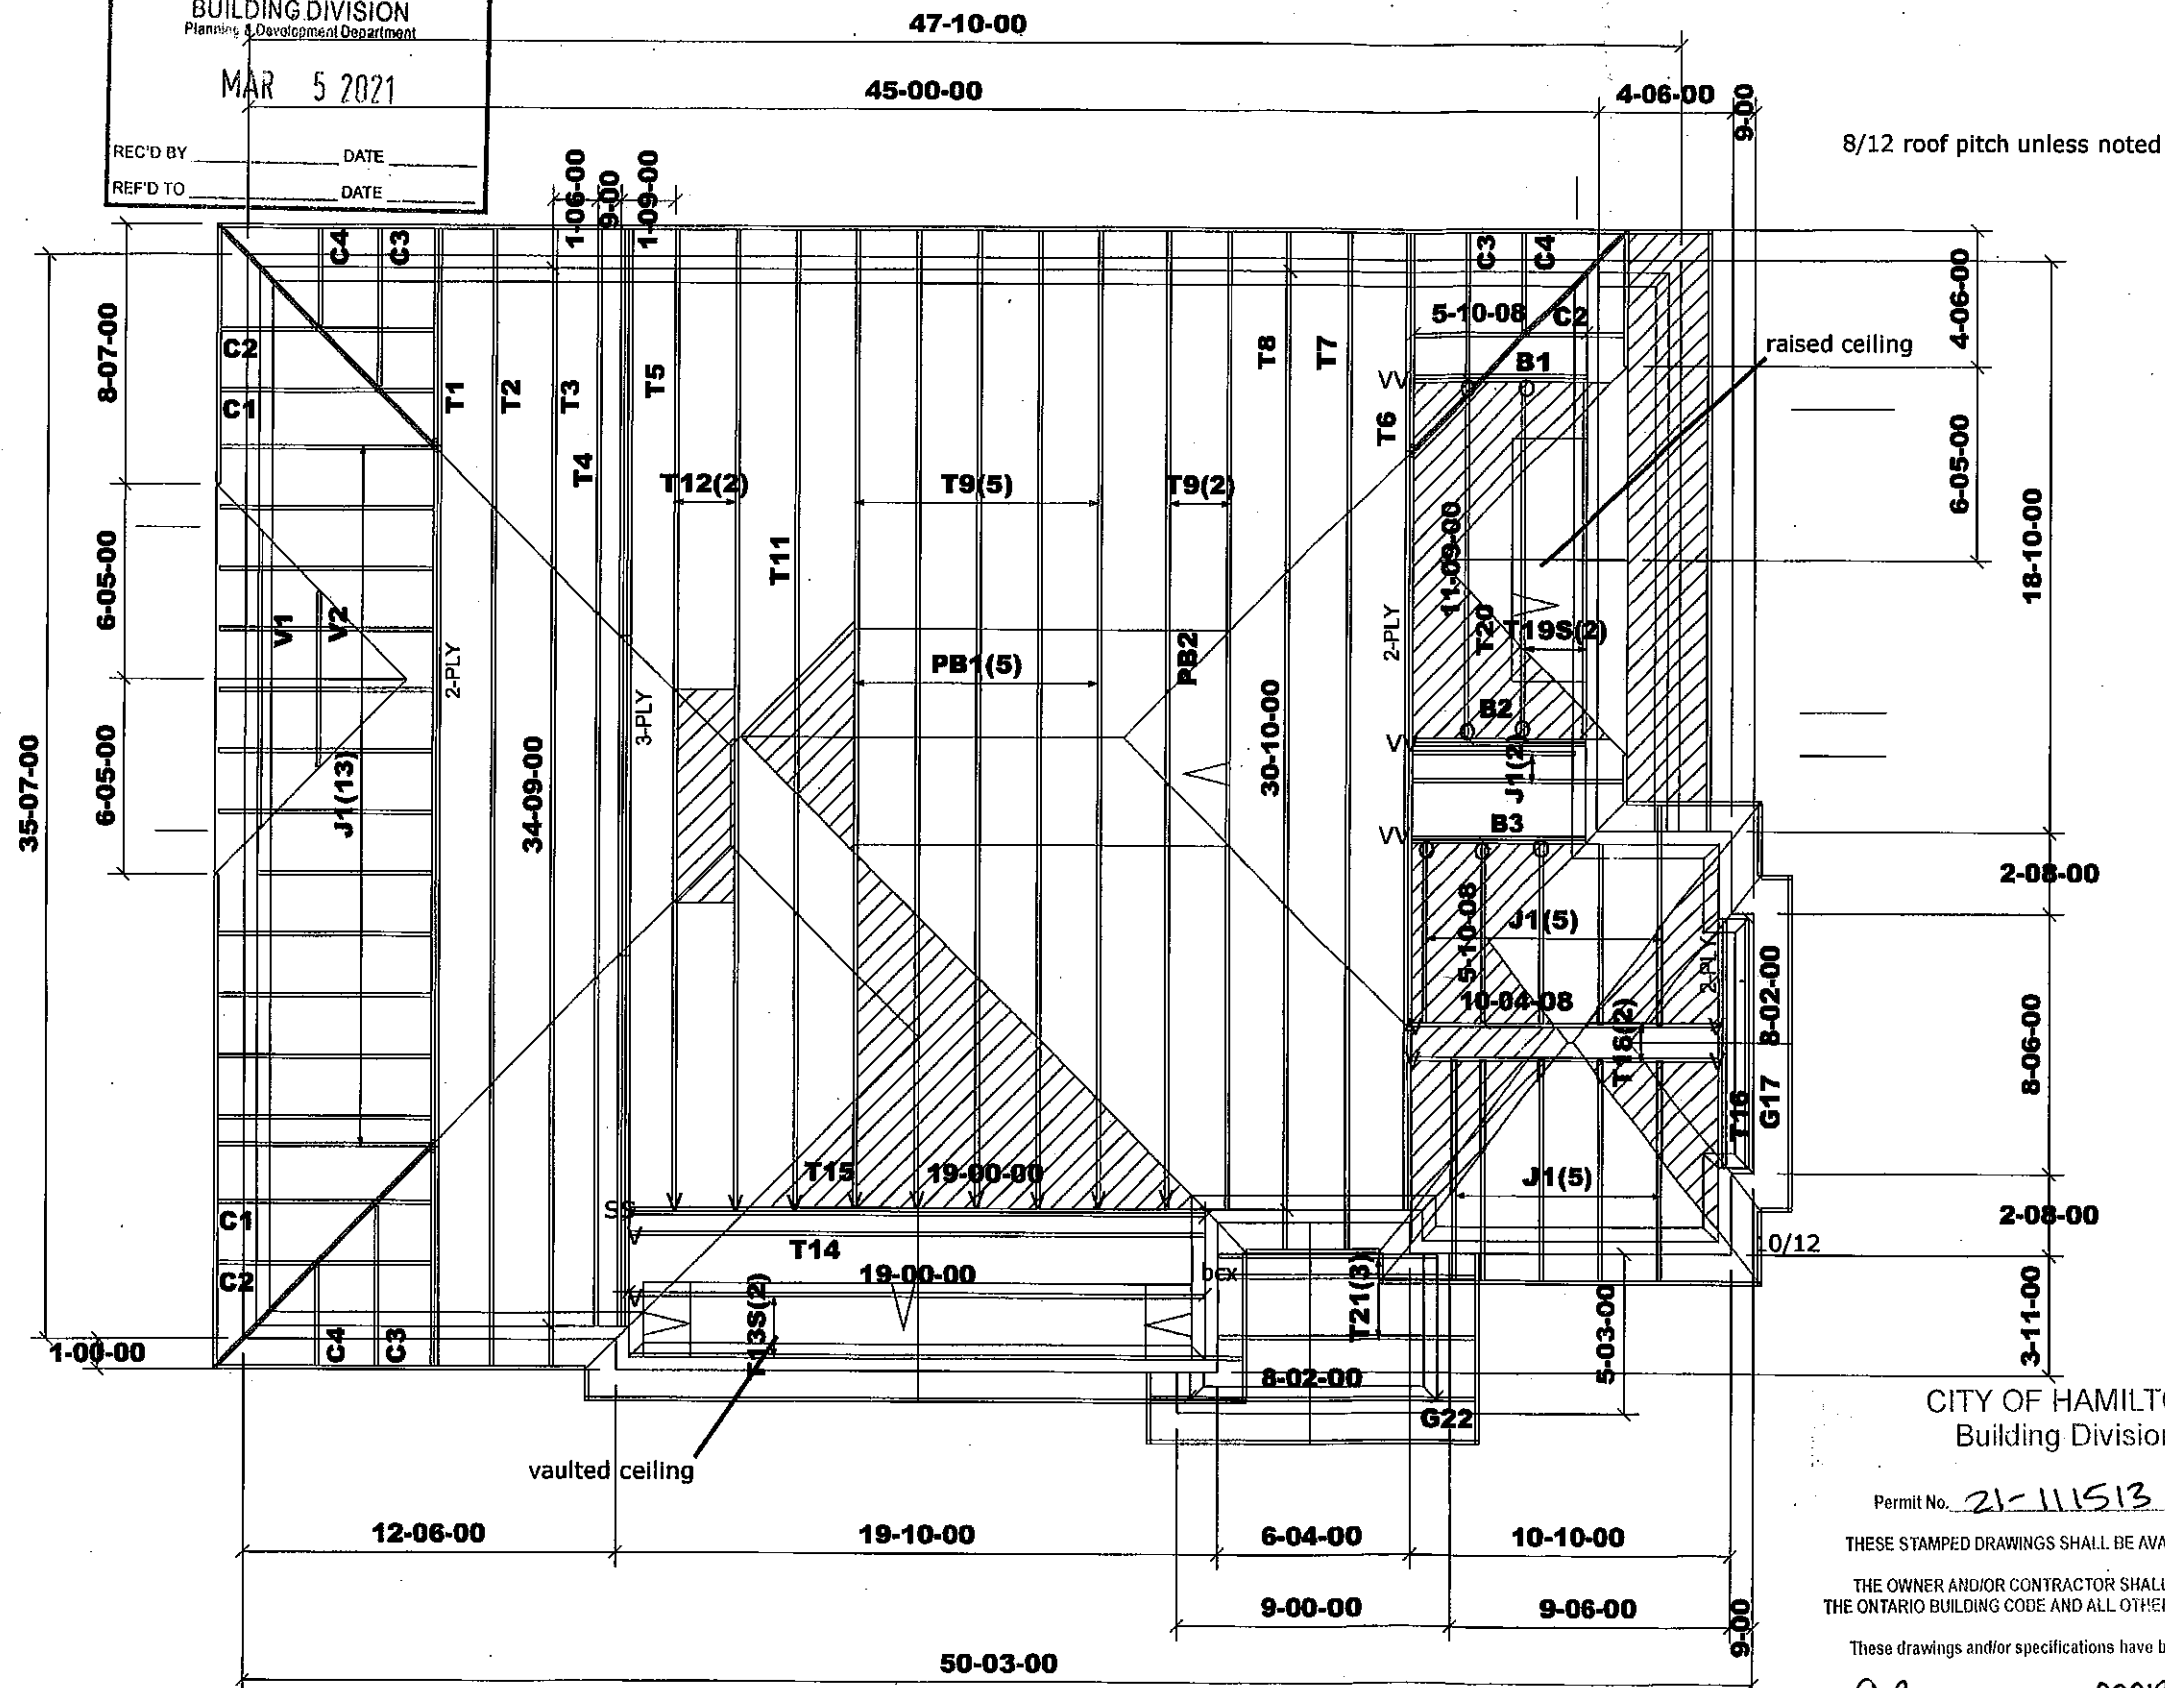

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.


All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012
(2019 amendment) OCCUPANCY:
RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS28-2 - (SS)
LUS26-2-(VV)

BEAMS:
B1= B2 = B3 = wB3
2 - 2x10 SPF #2

 **DENOTES:
CONVENTIONAL
FRAMING**

CITY OF HAMILTON
Building Division

Permit No. 21-111513

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

 MAR 19/21
FOR CHIEF BUILDING OFFICIAL DATE

M13139



Job Track: 51225
Plan Log: 202438
Layout ID: 408312

Builder / Location:
GREEN PARK HOMES / WATERDOWN

Project: **RUSSELL GARDENS PH.3**


Date: 2020-04-29 Sales: Mario DiCano

Designer: JG

Model / Elevation:
MOUNTAINASH 11 & 11S/1

Mitek ver 8.3.1.215

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC.. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

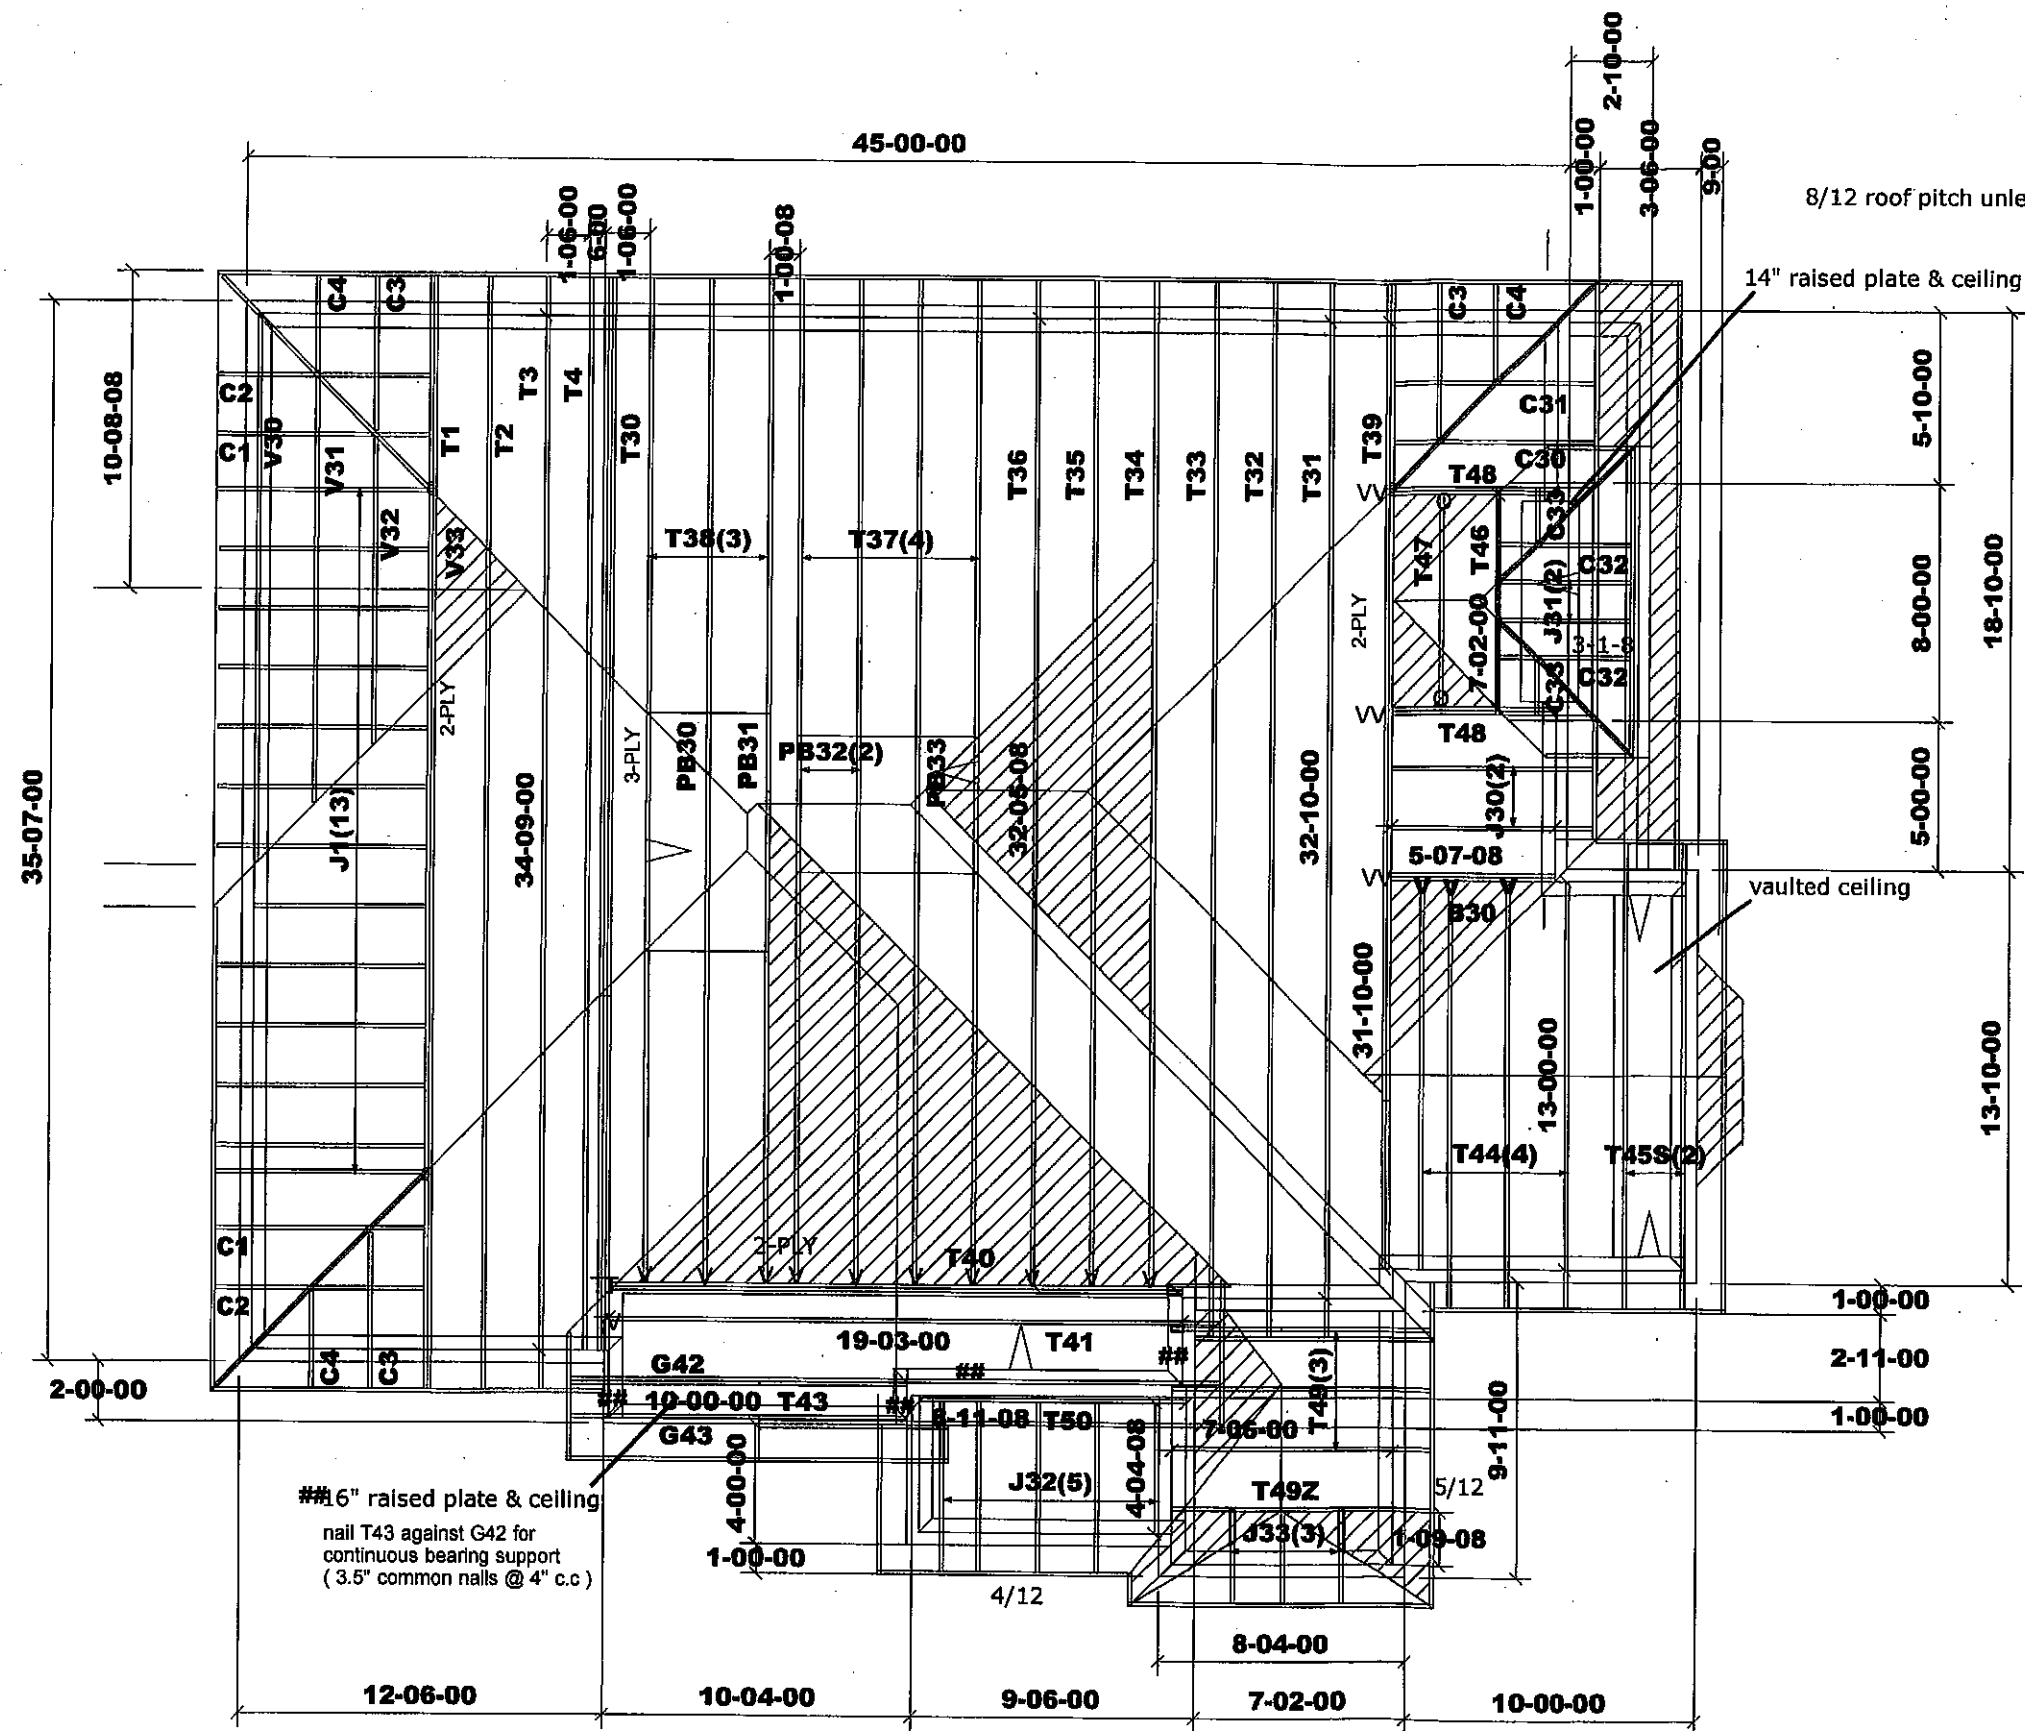

ASPHALT SHINGLES
 FINISHED OVERHANG: 12"
 2x6 EXTERIOR WALLS
 2x6 FASCIA BOARD
 HEEL: R.T.M.C.

All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
 Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
 TCSL = 25.6 psf
 TCDL = 6.0 psf
 BCLL = 0.0 psf
 BCDL = 7.4 psf

HARDWARE:
 LUS24 - (O)
 LJS26DS - (V)
 THGQ2-SDS3(MAX)- (TT)
 LUS26-2-(VV)

BEAMS:
 B30= 2 - 2x10 SPF #2 = WB 3

 **DENOTES:**
 CONVENTIONAL
 FRAMING

M13139



Job Track: **51225**
 Plan Log: **202438**
 Layout ID: **408313**

Builder / Location: **GREEN PARK HOMES / WATERDOWN**

Project: **RUSSELL GARDENS PH.3**


Date: 2020-04-29 Sales: Mario DiCano

Designer: JG

Model / Elevation: **MOUNTAINASH 11 & 11S/2**

Milek ver 8.3.1.215

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

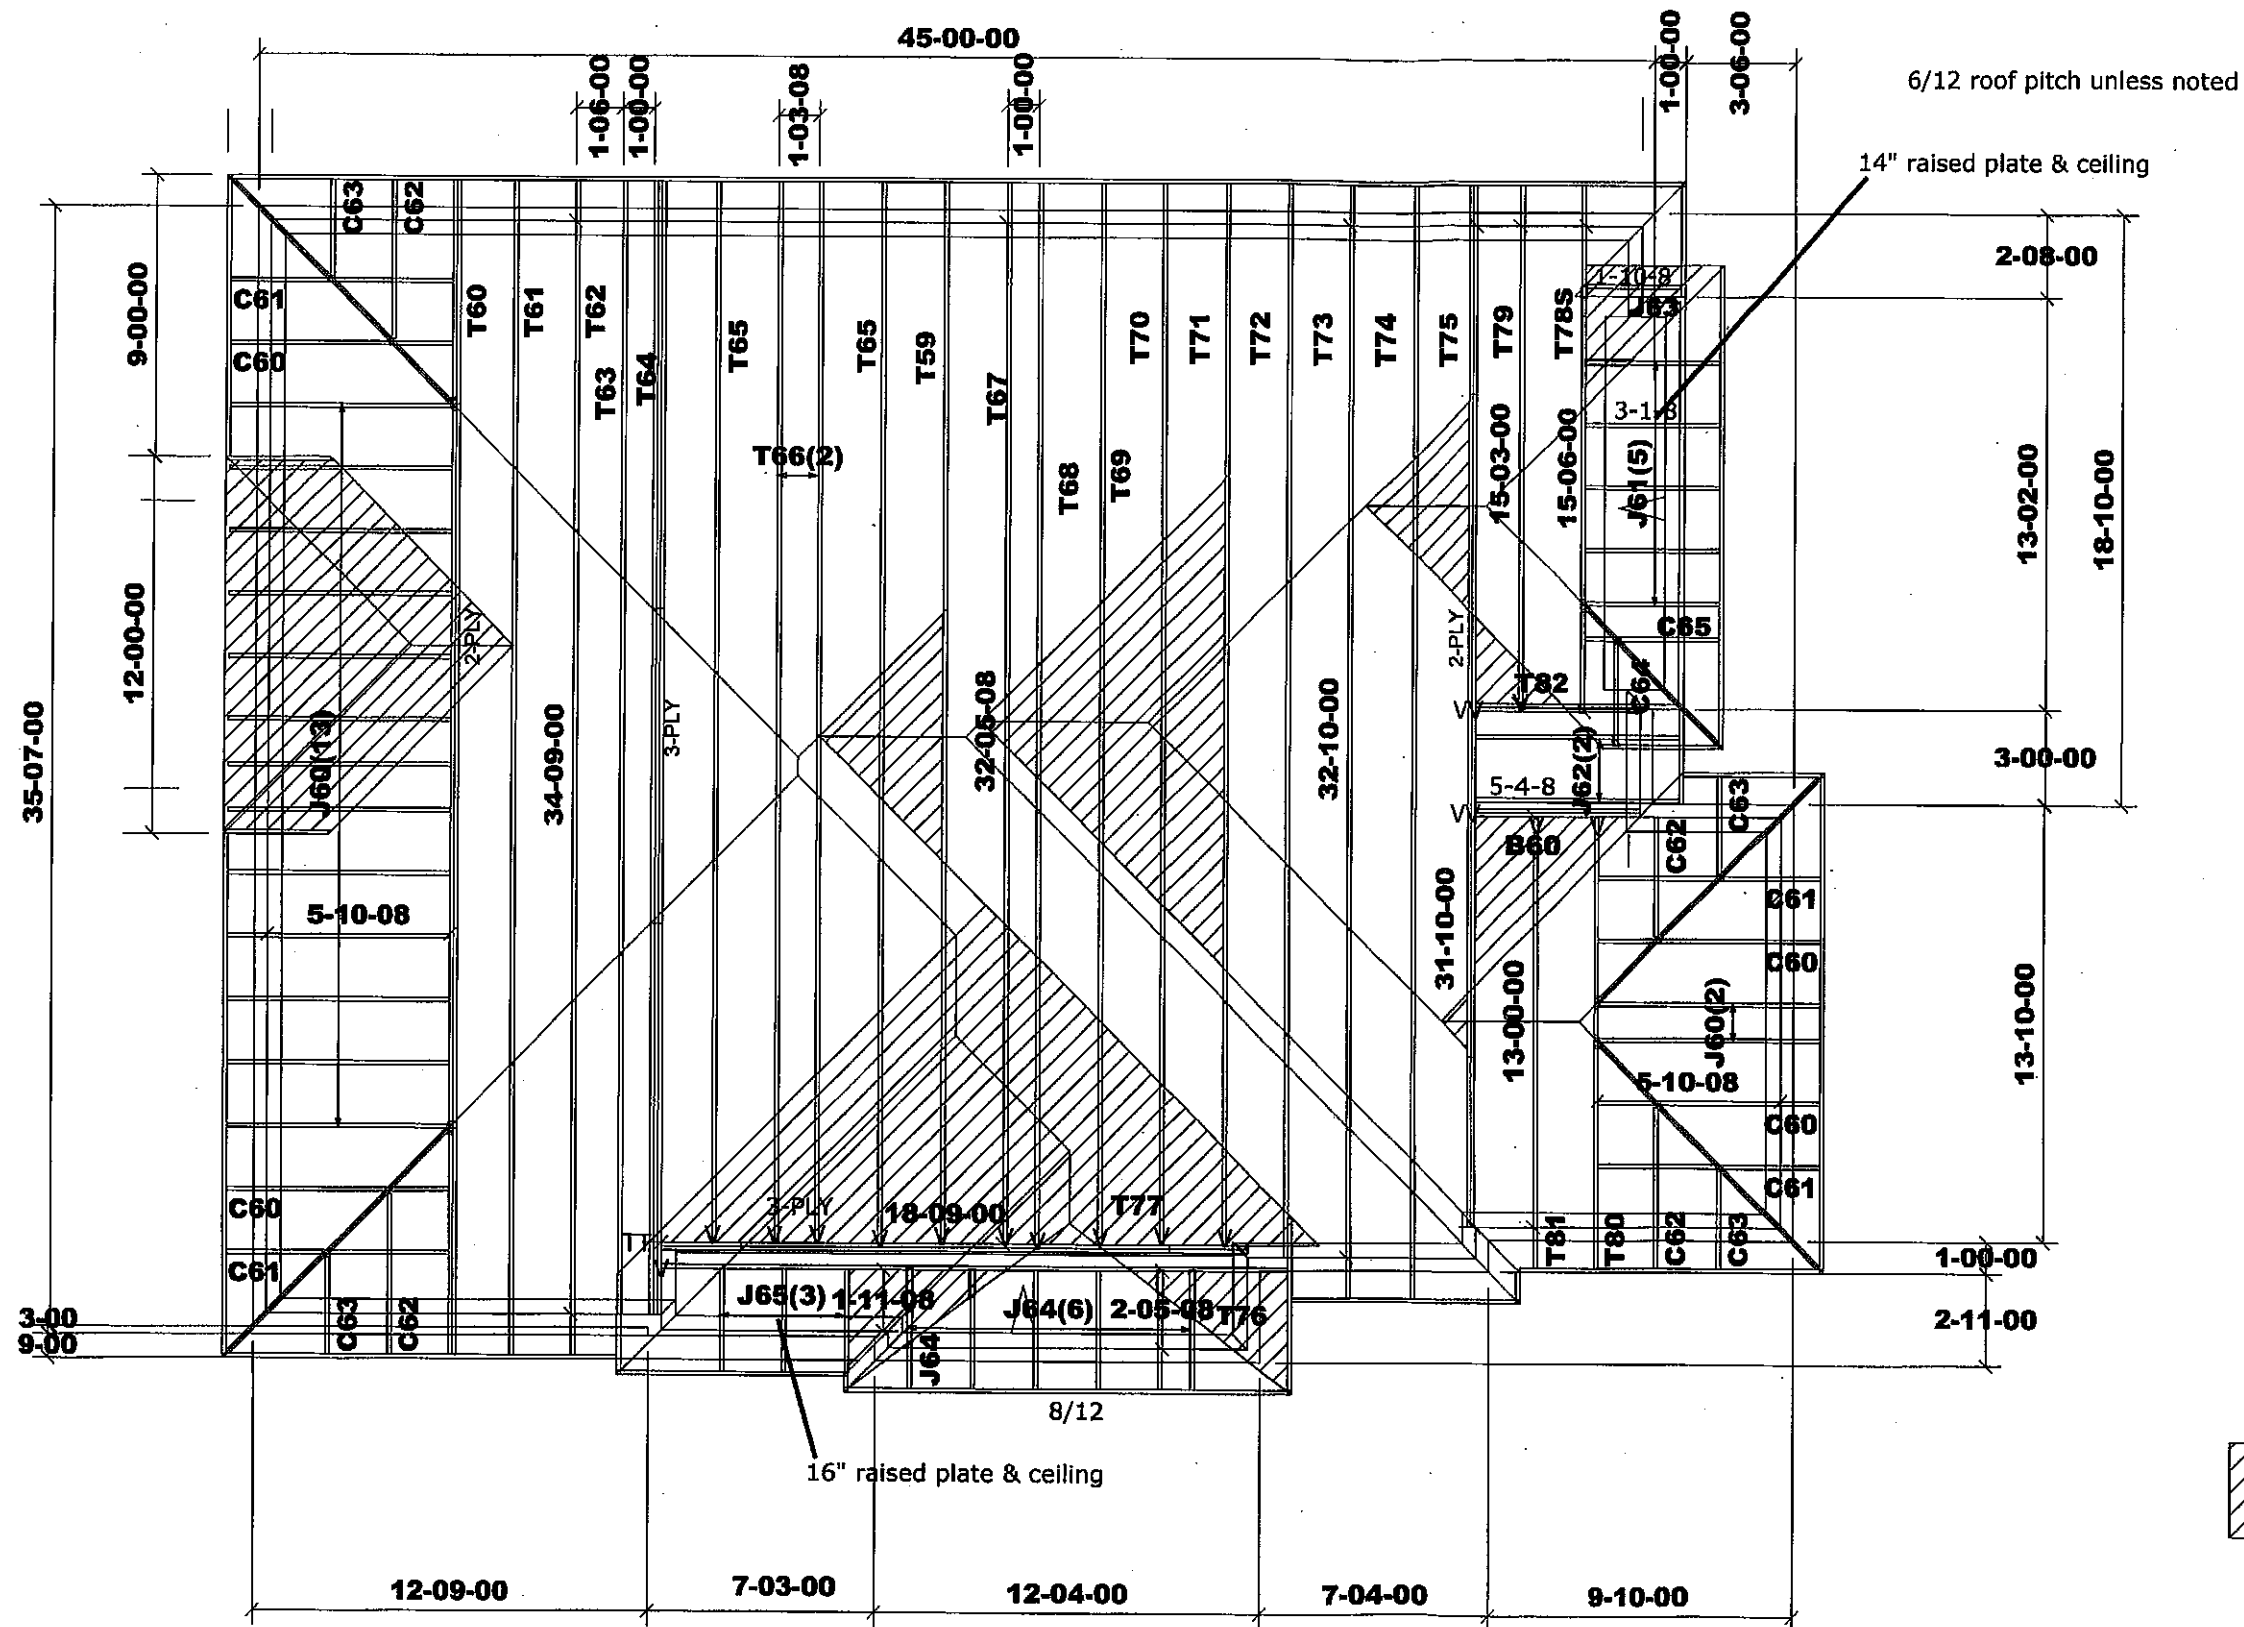

ASPHALT SHINGLES
 FINISHED OVERHANG: 12"
 2x6 EXTERIOR WALLS
 2x6 FASCIA BOARD
 HEEL: R.T.M.C.


All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.

DESIGN CONFORMS WITH OBC 2012 (2019 amendment) OCCUPANCY: RESIDENTIAL | PART: 9
 Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
 TCSL = 25.6 psf
 TCDL = 6.0 psf
 BCLL = 0.0 psf
 BCDL = 7.4 psf

HARDWARE:
 LUS24 - (O)
 LJS26DS - (V)
 THGQ2-SDS3(MAX)- (TT)
 LUS26-2-(VV)

BEAMS:
 B60= 2 - 2x10 SPF #2 = W13 3

 **DENOTES:**
 CONVENTIONAL
 FRAMING

M13139



Job Track: **51225**
 Plan Log: **202438**
 Layout ID: **408314**

Builder / Location:
GREEN PARK HOMES / WATERDOWN

Project: **RUSSELL GARDENS PH.3**

Date: 2020-04-29 Sales: Mario DiCano

Designer: JG

Model / Elevation:
MOUNTAINASH 11/3 & 115/3

Mitek ver 8.3.1.215

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 11 #115
 Lot #:
 Elevation: 1

Job Track: 51225
 PlanLog: 202438
 Layout ID: 408312
 Ref #
 Page: 1 of 3
 Date: 04-28-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	8 / 12	34-09-00	5-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	325.22 199.00		
	1	T2 Hip	8 / 12	34-09-00	6-07-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	149.66 95.50		
	1	T3 Hip	8 / 12	34-09-00	7-11-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	158.41 97.00		
	1	T4 Hip	8 / 12	34-09-00	8-11-13	2 x 4	1-03-08	1-04-13 1-04-13	160.85 99.83		
	1 3-ply	T5 Hip Girder	8 / 12	34-09-00	9-05-13	2 x 4 2 x 8	1-03-08 1-03-08	1-04-13 1-04-13	639.14 398.50		
	1 2-ply	T6 Hip Girder	8 / 12	30-10-00	5-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	297.55 183.67		
	1	T7 Hip	8 / 12	30-10-00	6-07-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	130.21 83.17		
	1	T8 Hip	8 / 12	30-10-00	7-11-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	138.71 87.67		
	7	T9 Hip	8 / 12	30-10-00	9-03-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	986.09 616.00		
	1	T11 Hip	8 / 12	30-10-00	10-04-13	2 x 4	1-03-08	1-04-13 4-00-02	164.38 95.00		
	2	T12 Hip	8 / 12	30-10-00	10-07-13	2 x 4	1-03-08	1-04-13 4-00-02	325.04 200.67		
	2	T13S Roof Special	8 / 12 8 / 12	19-00-00	7-08-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	162.98 109.00		
	1	T14 Common	8 / 12	19-00-00	7-08-13	2 x 4		1-04-13 1-04-13	79.65 49.67		
	1 2-ply	T15 Common Girder	8 / 12	19-00-00	7-08-13	2 x 4 2 x 6		1-04-13 1-04-13	205.18 124.00		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 11 *4/15*
 Lot #:
 Elevation: 1

Job Track: 51225
 PlanLog: 202438
 Layout ID: 408312
 Ref #
 Page: 2 of 3
 Date: 04-28-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T16 Common Girder	8 /12	8-02-00	4-01-08	2 x 4 2 x 6		1-04-13 1-04-13	73.81 50.67		
	1	G17 GABLE	8 /12	8-02-00	4-01-08	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	36.27 23.67		
	2	T18 Hip Girder	10 /12	10-04-08	5-03-13	2 x 4		1-07-10 1-03-14	97.27 63.67		
	2	T19S Roof Special	8 /12	11-09-00	4-08-13	2 x 4		9-13 9-13	96.77 66.67		
	1	T20 Common	8 /12	11-09-00	4-08-13	2 x 4		9-13 9-13	45.53 30.50		
	3	T21 Common	8 /12	7-02-08	3-11-03	2 x 4	1-03-08	4-07 1-00-02	83.14 55.00		
	1	G22 GABLE	8 /12	8-02-00	3-11-03	2 x 4	1-03-08 1-03-08	4-07 4-07	26.42 18.83		
	5	PB1 Piggyback	8 /12	7-01-00	2-04-05	2 x 4			86.92 58.33		
	1	PB2 Piggyback	8 /12	7-01-00	1-04-00	2 x 4			18.62 13.17		
	1	V1 Valley	8 /12	9-09-00	3-03-00	2 x 4			25.26 16.17		
	1	V2 Valley	8 /12	5-09-00	1-11-00	2 x 4			14.13 9.00		
	25	J1 Jack-Open	8 /12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	479.77 291.67		
	2	C1 Jack-Open	8 /12	3-10-15	4-00-02	2 x 4	1-03-08 1-11-09	1-04-13 4-00-02	33 20.67		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 11 ~~4115~~
 Lot #:
 Elevation: 1

Job Track: 51225
 PlanLog: 202438
 Layout ID: 408312
 Ref #
 Page: 3 of 3
 Date: 04-28-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	3	C2 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 3-11-09	1-04-13 2-08-02	41.18 27.00		
	3	C3 Jack-Open	8 /12	2-00-00	4-00-02	2 x 4	1-03-08 1-10-15	1-04-13 2-08-13	36.94 23.00		
	3	C4 Jack-Open	8 /12	1-10-15	2-08-02	2 x 4	1-03-08 1-01	1-04-13 2-08-02	28.72 19.00		

TOTAL #TRUSS= 93

TOTAL BFT OF ALL TRUSSES= 3299.03 BFT.

TOTAL WEIGHT OF ALL TRSSES 5242.28 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS28-2	
15	Hardware	LJS26DS	
7	Hardware	LUS24	
3	Hardware	LUS26-2	

TOTAL NUMBER OF
ITEMS=

26

DELIVERY SHIPLIST




Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 11 *4/15*
 Lot #:
 Elevation: 2

Job Track: 51225
 PlanLog: 202438
 Layout ID: 408313
 Ref #
 Page: 1 of 4
 Date: 04-29-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	8 / 12	34-09-00	5-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	325.22 199.00		
	1	T2 Hip	8 / 12	34-09-00	6-07-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	149.88 95.50		
	1	T3 Hip	8 / 12	34-09-00	7-11-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	156.41 97.00		
	1	T4 Hip	8 / 12	34-09-00	8-11-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	162.82 101.17		
	1 3-ply	T30 Hip Girder	8 / 12	34-09-00	9-03-13	2 x 4 2 x 8	1-03-08 1-03-08	1-04-13 1-04-13	648.54 399.50		
	1	T31 Roof Special	8 / 12	32-10-00	6-05-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	143.2 88.50		
	1	T32 Roof Special	8 / 12	32-10-00	7-09-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	145.19 91.33		
	1	T33 Roof Special	8 / 12	32-10-00	9-01-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	157.98 98.50		
	1	T34 Hip	8 / 12	32-05-08	6-09-13	2 x 4	1-03-08	1-04-13 1-07-13	143.16 91.50		
	1	T35 Hip	8 / 12	32-05-08	8-01-13	2 x 4	1-03-08	1-04-13 1-07-13	142.84 89.00		
	1	T36 Hip	8 / 12	32-05-08	9-05-13	2 x 4	1-03-08	1-04-13 1-07-13	151.81 93.83		
	4	T37 Hip	8 / 12	32-05-08	10-09-13	2 x 4	1-03-08	1-04-13 1-07-13	621.64 381.33		
	3	T38 Hip	8 / 12	32-05-08	10-03-13	2 x 4	1-03-08	1-04-13 2-11-02	471.17 291.00		
	1 2-ply	T39 Hip Girder	8 / 12	31-10-00	5-01-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	302.04 185.00		

DELIVERY SHIPLIST

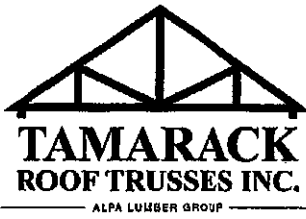

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 11 *4115*
 Lot #:
 Elevation: 2

Job Track: 51225
 PlanLog: 202438
 Layout ID: 408313
 Ref #
 Page: 2 of 4
 Date: 04-29-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T40 Common Girder	8/12	19-03-00	9-01-13	2 x 4 2 x 6		2-08-13 2-08-13	235.46 148.00		
	1	T41 Roof Special	8/12	19-03-00	9-01-13	2 x 4	1-03-08	1-04-13 1-04-13	85.51 53.17		
	1	G42 GABLE	8/12	19-03-00	7-09-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	88.36 56.33		
	1	T43 Common	8/12	10-00-00	4-08-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	42.28 26.17		
	1	G43 GABLE	8/12	10-00-00	4-08-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	43.48 28.17		
	4	T44 Common	8/12	13-00-00	5-08-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	227.01 146.33		
	2	T45S Scissor	8/12 6/12	13-00-00	5-08-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	110.07 74.33		
	1	T46 Hip Girder	8/12	7-08-00	3-05-13	2 x 4		1-04-13 1-04-13	33.64 21.33		
	1	T47 Common	8/12	7-02-00	5-01-08	2 x 4		2-08-13 2-08-13	33.69 22.50		
	2 2-ply	T48 Flat Girder	0/12	5-07-08	1-02-00	2 x 4		1-02-00 1-02-00	74.68 51.33		
	3	T49 Common	5/12	7-06-00	2-05-00	2 x 4	1-03-08	5-06 5-06	67.28 45.00		
	1	T49Z Common Girder	5/12	7-06-00	2-05-00	2 x 4	1-03-08 1-03-08	5-06 5-06	24.02 15.67		
	1	T50 Flat Girder	0/12	8-11-08	1-09-07	2 x 4		1-09-07 1-09-07	31.09 20.67		
	1	V30 Valley	8/12	18-04-00	6-01-05	2 x 4			53.82 33.33		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 11 4115
 Lot #:
 Elevation: 2

Job Track: 51225
 PlanLog: 202438
 Layout ID: 408313
 Ref #
 Page: 3 of 4
 Date: 04-29-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	V31 Valley	8 /12	14-04-00	4-09-05	2 x 4			40.52 26.50		
	1	V32 Valley	8 /12	10-04-00	3-05-05	2 x 4			28.89 16.83		
	1	V33 Valley	8 /12	6-04-00	2-01-05	2 x 4			15.76 11.00		
	1	PB30 Piggyback	8 /12	8-00-00	1-04-00	2 x 4			21.44 14.33		
	1	PB31 Piggyback	8 /12	8-00-00	1-09-00	2 x 4			21.53 15.50		
	2	PB32 Piggyback	8 /12	4-07-00	1-06-05	2 x 4			19.82 13.33		
	1	PB33 Piggyback	8 /12	4-07-00	1-04-00	2 x 4			10.69 8.33		
	13	J1 Jack-Open	8 /12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	249.48 151.67		
	2	J30 Jack-Open	8 /12	5-07-08	5-01-13	2 x 4	1-03-08	1-04-13 5-01-13	37.13 23.33		
	2	J31 Jack-Open	8 /12	3-01-08	3-05-13	2 x 4	1-03-08	1-04-13 3-05-13	24.57 16.67		
	5	J32 Jack-Open	4 /12	4-04-08	2-02-06	2 x 4	1-03-08	3-15 1-09-07	59.55 40.00		
	3	J33 Jack-Open	8 /12	1-09-08	2-04-14	2 x 4	1-03-08	9-10 1-11-15	20.68 14.00		
	2	C1 Jack-Open	8 /12	3-10-15	4-00-02	2 x 4	1-05-00 1-11-09	1-04-13 4-00-02	33.34 20.67		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 11 *4115*
 Lot #:
 Elevation: 3

Job Track: 51225
 PlanLog: 202438
 Layout ID: 408314
 Ref #
 Page: 1 of 3
 Date: 04-29-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T59 Hip	6/12	32-05-08	7-04-04	2 x 4	1-03-08	1-02-00 2-03-12	137.61 88.33		
	1 2-ply	T60 Hip Girder	6/12	34-09-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	305.58 190.00		
	1	T61 Hip	6/12	34-09-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	137.77 88.33		
	1	T62 Hip	6/12	34-09-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	137.34 88.00		
	1	T63 Hip	6/12	34-09-00	6-10-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	141.78 89.17		
	1 3-ply	T64 Hip Girder	6/12	34-09-00	7-04-04	2 x 4 2 x 8	1-03-08 1-03-08	1-02-00 1-02-00	601.89 372.50		
	2	T65 Hip	6/12	32-05-08	8-04-04	2 x 4	1-03-08	1-02-00 2-03-12	285.84 164.67		
	2	T66 Hip	6/12	32-05-08	9-04-04	2 x 4	1-03-08	1-02-00 2-03-12	300.63 189.67		
	1	T67 Hip	6/12	32-05-08	8-08-04	2 x 4	1-03-08	1-02-00 1-04-04	134.52 84.33		
	1	T68 Hip	6/12	32-05-08	8-02-04	2 x 4	1-03-08	1-02-00 1-04-04	131.67 81.83		
	1	T69 Hip	6/12	32-05-08	7-02-04	2 x 4	1-03-08	1-02-00 1-04-04	136.04 84.83		
	1	T70 Hip	6/12	32-05-08	6-02-04	2 x 4	1-03-08	1-02-00 1-04-04	129.64 81.00		
	1	T71 Hip	6/12	32-05-08	5-02-04	2 x 4	1-03-08	1-02-00 1-04-04	129.91 82.00		
	1	T72 Roof Special	6/12	32-10-00	6-10-04	2 x 4	1-03-08	1-02-00 1-02-00	137.77 87.50		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 11 *4115*
 Lot #:
 Elevation: 3

Job Track: 51225
 PlanLog: 202438
 Layout ID: 408314
 Ref #
 Page: 2 of 3
 Date: 04-29-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T73 Roof Special	6/12	32-10-00	5-10-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	131.66 84.33		
	1	T74 Roof Special	6/12	32-10-00	4-10-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	128.86 81.50		
	1 2-ply	T75 Hip Girder	6/12	31-10-00	3-10-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	281.04 172.67		
	1	T76 Roof Special Girder	6/12	18-09-00	4-04-08	2 x 4	1-03-08	1-02-00 1-02-00	73.99 49.33		
	1 2-ply	T77 Hip Girder	6/12	18-09-00	3-09-04	2 x 4 2 x 6		2-06-00 2-06-00	194.56 122.67		
	1	T78S Hip Girder	6/12	15-06-00	4-00-12	2 x 4	1-03-08	1-02-00 1-00-08	83.02 42.17		
	1	T79 Hip	6/12	15-03-00	5-00-12	2 x 4	1-03-08	1-02-00 2-06-00	84.54 42.17		
	1	T80 Hip Girder	6/12	13-00-00	4-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	54.28 35.33		
	1	T81 Common	6/12	13-00-00	4-05-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	52.02 32.00		
	1 2-ply	T82 Flat Girder	0/12	5-04-08	1-04-00	2 x 6		1-04-00 1-04-00	48.25 31.67		
	15	J60 Jack-Open	6/12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	251.92 160.00		
	5	J61 Jack-Open	6/12	3-01-08	2-08-12	2 x 4	1-03-08	1-02-00 2-08-12	50.76 36.67		
	2	J62 Jack-Open	6/12	5-04-08	3-10-04	2 x 4	1-03-08	1-02-00 3-10-04	31.17 20.00		
	1	J63 Jack-Open	6/12	1-10-08	2-01-04	2 x 4	1-03-08	1-02-00 2-01-04	7.13 4.67		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 11 #115
 Lot #:
 Elevation: 3

Job Track: 51225
 PlanLog: 202438
 Layout ID: 408314
 Ref #
 Page: 3 of 3
 Date: 04-29-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	6	J64 Jack-Open	8 / 12	2-05-08	3-00-08	2 x 4	1-03-08	1-04-13 3-00-08	87.08 45.00		
	3	J65 Jack-Open	6 / 12	1-11-08	2-01-12	2 x 4	1-03-08	1-02-00 2-01-12	22 14.00		
	4	C60 Jack-Open	6 / 12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	56.53 34.67		
	4	C61 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	46.33 29.33		
	4	C62 Jack-Open	6 / 12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	38.28 24.00		
	4	C63 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	28.08 18.67		
	1	C64 Jack-Open	6 / 12	1-10-15	2-01-08	2 x 4	1-03-08 1-01	1-02-00 2-01-08	7.32 4.67		
	1	C65 Jack-Open	6 / 12	1-10-15	2-01-08	2 x 4	1-03-08 1-02-09	1-02-00 2-01-08	8.61 6.00		

TOTAL # TRUSS= 82

TOTAL BFT OF ALL TRUSSES= 2857.68

BFT.

TOTAL WEIGHT OF ALL TRSSES 4534.94 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
14	Hardware	LJS28DS	
2	Hardware	LUS26-2	
1		THGQ2-SDS3(MAX)	

TOTAL NUMBER OF
ITEMS=

17

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 11 *\$115*
 Lot #:
 Elevation: 2

Job Track: 51225
 PlanLog: 202438
 Layout ID: 408313
 Ref #
 Page: 4 of 4
 Date: 04-29-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	C2 Jack-Open	8 / 12	1-10-15	2-08-02	2 x 4	1-05-00 3-11-09	1-04-13 2-08-02	27.79 18.00		
	3	C3 Jack-Open	8 / 12	2-00-00	4-00-02	2 x 4	1-03-08 1-10-15	1-04-13 2-08-13	36.94 23.00		
	3	C4 Jack-Open	8 / 12	1-10-15	2-08-02	2 x 4	1-03-08 1-01	1-04-13 2-08-02	28.72 19.00		
	1	C30 Jack-Open	8 / 12	3-10-15	4-00-02	2 x 4	1-03-08 1-08-09	1-04-13 4-00-02	16.21 10.33		
	1	C31 Jack-Open	8 / 12	1-10-15	2-08-02	2 x 4	1-03-08 3-08-09	1-04-13 2-08-02	13.44 9.00		
	2	C32 Jack-Open	8 / 12	1-09-07	2-07-02	2 x 4	1-03-08 1-04-01	1-04-13 2-07-02	20.66 14.00		
	2	C33 Jack-Open	8 / 12	1-10-08	2-07-02	2 x 4		1-04-13 2-07-13	14.39 10.00		

TOTAL # TRUSS= 104

TOTAL BFT OF ALL TRUSSES= 3577.65 BFT.

TOTAL WEIGHT OF ALL TRSSES 5695.18 LBS

HARDWARE


QTY	TYPE	MODEL	LENGTH
14	Hardware	LJS26DS	
2	Hardware	LUS24	
3	Hardware	LUS28-2	
1		THGQ2-SDS3(MAX)	

TOTAL NUMBER OF
ITEMS=

20

JOB NAME 408312	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Wed Apr 29 16:28:05 2020 Page 1
ID:DMCubINVR8TstFoe31v6L_zns1L-U4HraIfc708qCTeIN42EhbFPyL_cJwOXHMA7zLcWw
23-0-14 23-0-14 27-11-4 28-10-8 34-9-0 38-0-8 1-3-8
Scale = 1:57.0

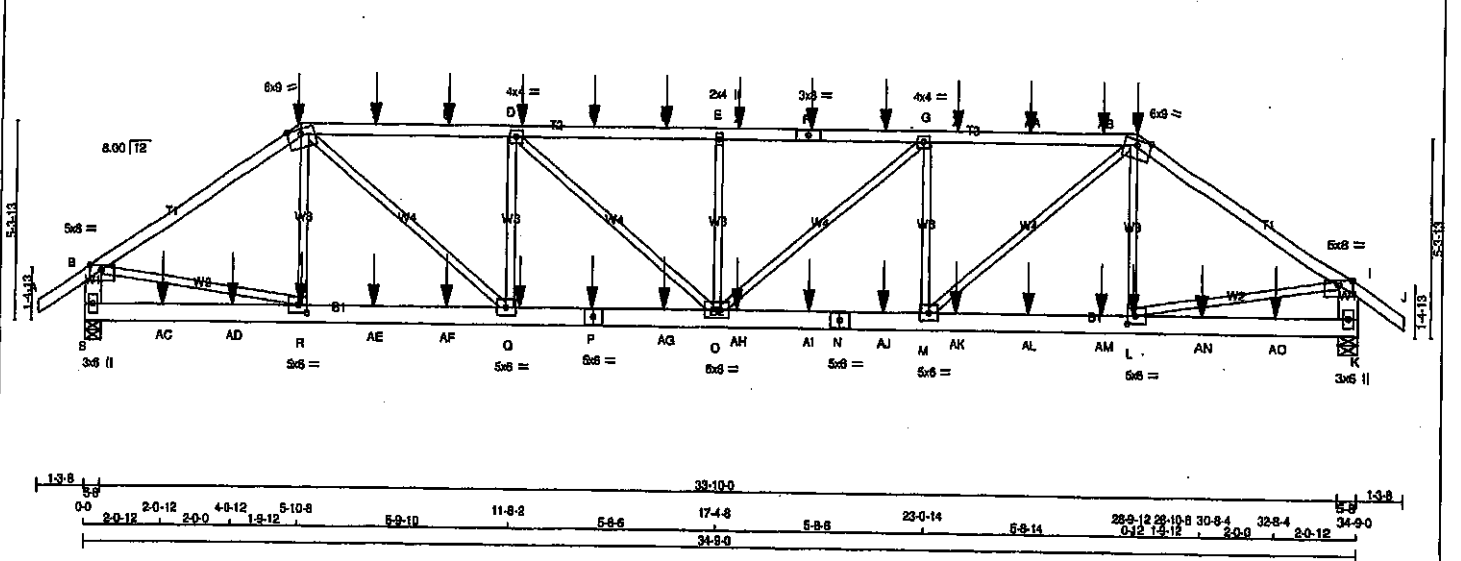

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x6	DRY	No.2
K - I	2x6	DRY	No.2
S - P	2x6	DRY	No.2
P - N	2x6	DRY	No.2
N - K	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	12	SIDE(81.0)
C-F	12	SIDE(81.0)
F-H	12	SIDE(81.0)
H-J	12	SIDE(81.0)
S-B	2	TOP
K-I	2	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S-P	2	SIDE(183.1)
P-N	2	SIDE(183.1)
N-K	2	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
R-C	6	SIDE(20.4)
L-H	6	SIDE(20.4)
2x3	6	SIDE(20.4)

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT		DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
S	3834	0	3834	0	5-8	5-8	
K	3908	0	3908	0	5-8	5-8	

UNFACTORED REACTIONS		MAX/MIN COMPONENT REACTIONS	
1ST LCASE		PERM	LIVE
JT	COMBINED	2710	1789 / 0
S		0 / 0	0 / 0
K		2762	1823 / 0
		0 / 0	0 / 0
		0 / 0	0 / 0
		0 / 0	0 / 0
		939 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.90 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)	
CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0 / 35	R-C	-428 / 44
B-C	-4846 / 0	C-Q	0 / 3021
C-T	-5318 / 0	Q-D	-1749 / 0
C-T	-5318 / 0	D-O	0 / 894
T-U	-5318 / 0	O-E	-943 / 0
U-D	-5318 / 0	E-G	0 / 828
D-V	-5992 / 0	G-H	-1715 / 0
V-W	-5992 / 0	H-I	0 / 2971
W-E	-5992 / 0	I-H	-427 / 60
E-X	-5992 / 0	H-R	0 / 4078
X-F	-5992 / 0	L-I	0 / 4167
F-Y	-5992 / 0		
Y-G	-5992 / 0		
G-Z	-5992 / 0		
Z-AA	-5992 / 0		
AA-AB	-5992 / 0		
AB-H	-5992 / 0		
H-I	-4946 / 0		
I-J	0 / 35		
S-B	-3758 / 0		
K-I	-3831 / 0		

S-AC	0 / 0	-18.5	-18.5	0.07 (4)	10.00
AC-AD	0 / 0	-18.5	-18.5	0.07 (4)	10.00
AD-R	0 / 0	-18.5	-18.5	0.07 (4)	10.00
R-AE	0 / 4014	-18.5	-18.5	0.30 (1)	10.00
AE-AF	0 / 4014	-18.5	-18.5	0.30 (1)	10.00
AF-Q	0 / 4014	-18.5	-18.5	0.30 (1)	10.00
Q-P	0 / 6316	-18.5	-18.5	0.47 (1)	10.00
P-AG	0 / 6316	-18.5	-18.5	0.47 (1)	10.00
AG-O	0 / 6316	-18.5	-18.5	0.47 (1)	10.00
O-AH	0 / 6368	-18.5	-18.5	0.48 (1)	10.00
AH-AI	0 / 6368	-18.5	-18.5	0.48 (1)	10.00
AI-N	0 / 6368	-18.5	-18.5	0.48 (1)	10.00
N-AJ	0 / 6368	-18.5	-18.5	0.48 (1)	10.00
AJ-M	0 / 6368	-18.5	-18.5	0.48 (1)	10.00
MAK	0 / 4102	-18.5	-18.5	0.31 (1)	10.00
AK-AL	0 / 4102	-18.5	-18.5	0.31 (1)	10.00
AL-AM	0 / 4102	-18.5	-18.5	0.31 (1)	10.00
AM-L	0 / 4102	-18.5	-18.5	0.31 (1)	10.00
L-AN	0 / 0	-18.5	-18.5	0.07 (4)	10.00
AN-AO	0 / 0	-18.5	-18.5	0.07 (4)	10.00
AO-K	0 / 0	-18.5	-18.5	0.07 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN PLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.18")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.34")

CSI: TC=0.88/1.00 (E-G:1), BC=0.48/1.00 (M-O:1), WB=0.52/1.00 (L:1), SS=0.28/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(P) (P) (P) (P) (P)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1887 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.87 (R) (INPUT = 0.90)
JSI METAL= 0.81 (N) (INPUT = 1.00)



Structural component only
DWG# T-2007883 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408312	T1	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 29 16:28:05 2020 Page 2
ID:DMCubINVR6TstFae31v6I zns1I-U4HrAifc708aCTetN42EhbFPvL cJw0xXIIMA7zLpgW

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW-p	MT20	5.0	8.0	Edge	
C	TTWW-m	MT20	6.0	9.0	Edge	
D	TMW-l	MT20	4.0	4.0		
E	TMW-w	MT20	2.0	4.0		
F	TS-l	MT20	3.0	8.0		
G	TMW-l	MT20	4.0	4.0		
H	TTWW-m	MT20	6.0	9.0	Edge	
I	TMW-p	MT20	5.0	8.0	Edge	
K	BMV-l-p	MT20	3.0	6.0		
L	BMW-l	MT20	5.0	5.0	2.50	2.75
M	BMW-l	MT20	5.0	6.0		
N	BS-l	MT20	5.0	6.0		
O	BMW-l	MT20	5.0	6.0		
P	BS-l	MT20	5.0	6.0		
Q	BMW-l	MT20	5.0	6.0		
R	BMW-l	MT20	5.0	6.0	2.50	2.75
S	BMV-l-p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-546	-546		FRONT	VERT	TOTAL		C1
D	11-11-4	-178	-178		FRONT	VERT	TOTAL		C1
F	19-11-4	-178	-178		FRONT	VERT	TOTAL		C1
H	28-10-8	-546	-546		FRONT	VERT	TOTAL		C1
L	28-9-12	-36	-36		FRONT	VERT	TOTAL		C1
P	13-11-4	-36	-36		FRONT	VERT	TOTAL		C1
Q	11-11-4	-36	-36		FRONT	VERT	TOTAL		C1
R	5-11-4	-36	-36		FRONT	VERT	TOTAL		C1
T	7-11-4	-178	-178		FRONT	VERT	TOTAL		C1
U	9-11-4	-178	-178		FRONT	VERT	TOTAL		C1
V	13-11-4	-178	-178		FRONT	VERT	TOTAL		C1
W	15-11-4	-178	-178		FRONT	VERT	TOTAL		C1
X	17-11-4	-178	-178		FRONT	VERT	TOTAL		C1
Y	21-11-4	-178	-178		FRONT	VERT	TOTAL		C1
Z	23-11-4	-178	-178		FRONT	VERT	TOTAL		C1
AA	25-11-4	-178	-178		FRONT	VERT	TOTAL		C1
AB	27-11-4	-181	-181		FRONT	VERT	TOTAL		C1
AC	2-0-12	-36	-36		FRONT	VERT	TOTAL		C1
AD	4-0-12	-36	-36		FRONT	VERT	TOTAL		C1
AE	7-11-4	-36	-36		FRONT	VERT	TOTAL		C1
AF	9-11-4	-36	-36		FRONT	VERT	TOTAL		C1
AG	15-11-4	-36	-36		FRONT	VERT	TOTAL		C1
AH	17-11-4	-36	-36		FRONT	VERT	TOTAL		C1
AI	19-11-4	-36	-36		FRONT	VERT	TOTAL		C1
AJ	21-11-4	-36	-36		FRONT	VERT	TOTAL		C1
AK	23-11-4	-36	-36		FRONT	VERT	TOTAL		C1
AL	25-11-4	-36	-36		FRONT	VERT	TOTAL		C1
AM	27-11-4	-36	-36		FRONT	VERT	TOTAL		C1
AN	30-8-4	-36	-36		FRONT	VERT	TOTAL		C1
AO	32-8-4	-36	-36		FRONT	VERT	TOTAL		C1

CONNECTION REQUIREMENTS


- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

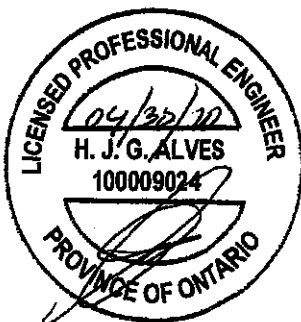

Structural component only
DWG# T-2007883

Structural component only
DWG# T-2007884

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408312	T3	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

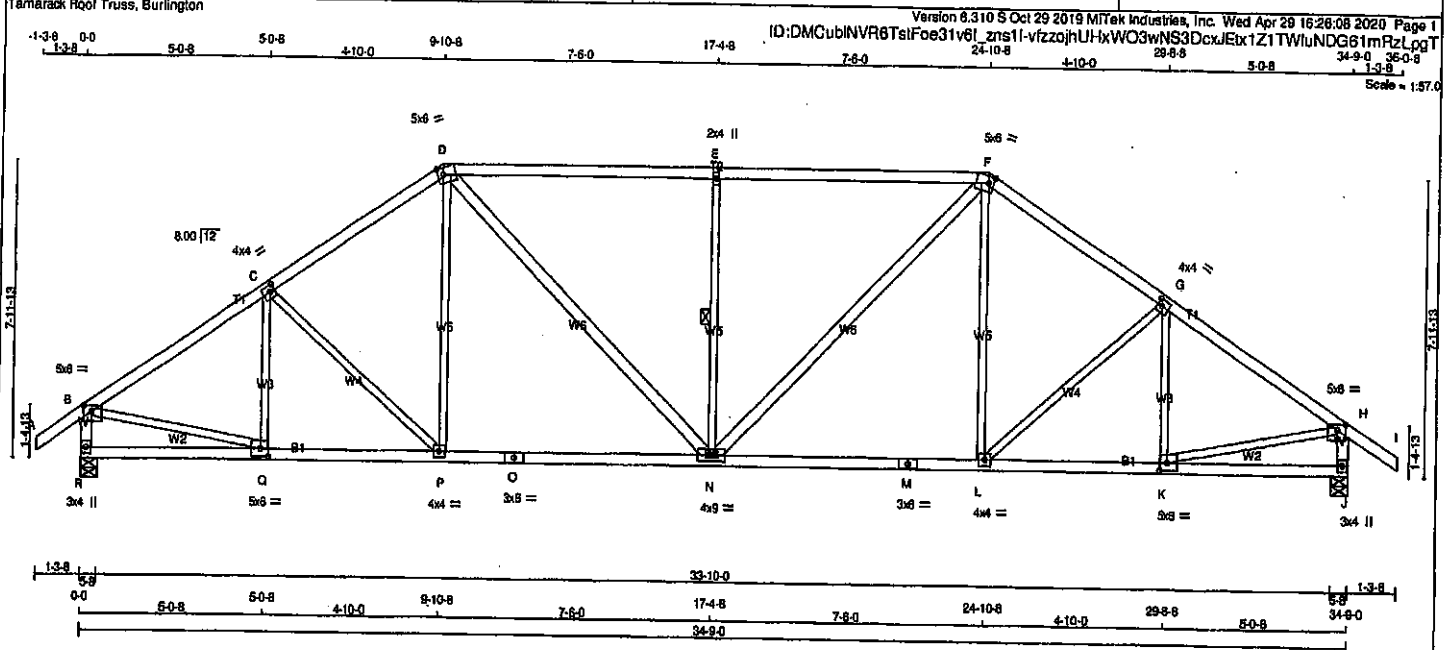

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - F	2x4	DRY	No.2	SPF		
F - I	2x4	DRY	No.2	SPF		
R - B	2x4	DRY	No.2	SPF		
J - H	2x4	DRY	No.2	SPF		
R - O	2x4	DRY	No.2	SPF		
O - M	2x4	DRY	No.2	SPF		
M - J	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						
D - N	2x4	DRY	No.2	SPF		
N - F	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (table is in inches)							
JT	TYPE	PLATES	W	LEN	Y	X	
B	TMVW-p	MT20	5.0	8.0	1.75	2.75	
C	TMVW-i	MT20	4.0	4.0	2.00	1.50	
D	TTWW-m	MT20	5.0	8.0	2.25	1.75	
E	TMVW-w	MT20	2.0	4.0			
F	TTWW-m	MT20	5.0	8.0	2.25	1.75	
G	TMVW-i	MT20	4.0	4.0	2.00	1.50	
H	TMVW-p	MT20	5.0	8.0	1.75	2.75	
J	BMV-i-p	MT20	3.0	4.0			
K	BMVW-i	MT20	5.0	8.0	2.50	2.75	
L	BMVW-i	MT20	4.0	4.0			
M	BS-i	MT20	3.0	6.0			
N	BMVWW-i	MT20	4.0	9.0			
O	BS-i	MT20	3.0	8.0			
P	BMVW-i	MT20	4.0	4.0			
Q	BMVW-i	MT20	5.0	8.0	2.50	2.75	
R	BMV-i-p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORIZ	UPLIFT
R	2042	0	2042	0
J	2042	0	2042	0

UNFACTORED REACTIONS	1ST CASE	MAX/MIN. COMPONENT REACTIONS
	COMBINED	SNOW
JT	1441	959 / 0
R	1441	959 / 0
J	1441	959 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.50 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	CS1 (LC)	UNBRAC	MEMB.	MAX. FACTORED	MAX	CS1 (LC)
	FORCE (LBS)	VERT. LOAD (PLF)	FROM	TO	LENGTH	FR-TO			FORCE (LBS)	MAX	CS1 (LC)
A-B	0 / 35	-91.8	-91.8	0.12	(1)	10.00	Q-C	-324 / 0	0.11	(1)	
B-C	-2282 / 0	-91.8	-91.8	0.37	(1)	4.21	C-P	-207 / 0	0.17	(1)	
C-D	-2160 / 0	-91.8	-91.8	0.35	(1)	4.32	P-D	0 / 258	0.08	(4)	
D-E	-2258 / 0	-91.8	-91.8	0.80	(1)	3.50	D-N	0 / 682	0.11	(1)	
E-F	-2258 / 0	-91.8	-91.8	0.80	(1)	3.50	N-E	-848 / 0	0.34	(1)	
F-G	-2160 / 0	-91.8	-91.8	0.35	(1)	4.32	N-F	0 / 682	0.11	(1)	
G-H	-2282 / 0	-91.8	-91.8	0.37	(1)	4.21	L-F	0 / 258	0.08	(4)	
H-I	0 / 35	-91.8	-91.8	0.12	(1)	10.00	L-G	-207 / 0	0.17	(1)	
R-B	-1999 / 0	0.0	0.0	0.21	(1)	5.97	K-G	-324 / 0	0.11	(1)	
J-H	-1999 / 0	0.0	0.0	0.21	(1)	5.97	B-Q	0 / 1967	0.44	(1)	
R-Q	0 / 0	-18.5	-18.5	0.10	(4)	10.00	K-H	0 / 1967	0.44	(1)	
Q-P	0 / 1923	-18.5	-18.5	0.40	(1)	10.00					
P-O	0 / 1773	-18.5	-18.5	0.40	(1)	10.00					
O-N	0 / 1773	-18.5	-18.5	0.40	(1)	10.00					
N-M	0 / 1773	-18.5	-18.5	0.40	(1)	10.00					
M-L	0 / 1773	-18.5	-18.5	0.40	(1)	10.00					
L-K	0 / 1923	-18.5	-18.5	0.40	(1)	10.00					
K-J	0 / 0	-18.5	-18.5	0.10	(4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.8	PSF
DL	= 6.0	PSF
BOT CH. LL	= 0.0	PSF
DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = 1/998 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = 1/998 (0.21")

CSK: TC=0.80/1.00 (E-F:1), BC=0.40/1.00 (N-P:1), WB=0.44/1.00 (B-Q:1), SS=0.33/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1688

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.88 (H) (INPUT = 0.80)
JSI METAL = 0.98 (C) (INPUT = 1.00)

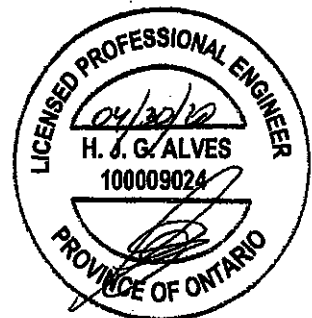


Structural component only
DWG# T-2007885

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408312	T4	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Wed Apr 29 16:26:09 2020 Page 1

ID:DMCubINVR6TstF0e31v6l_zns11-NrXM73i62FeFh4yecw7AsRQBazN1F4XSwraLuzLpgS

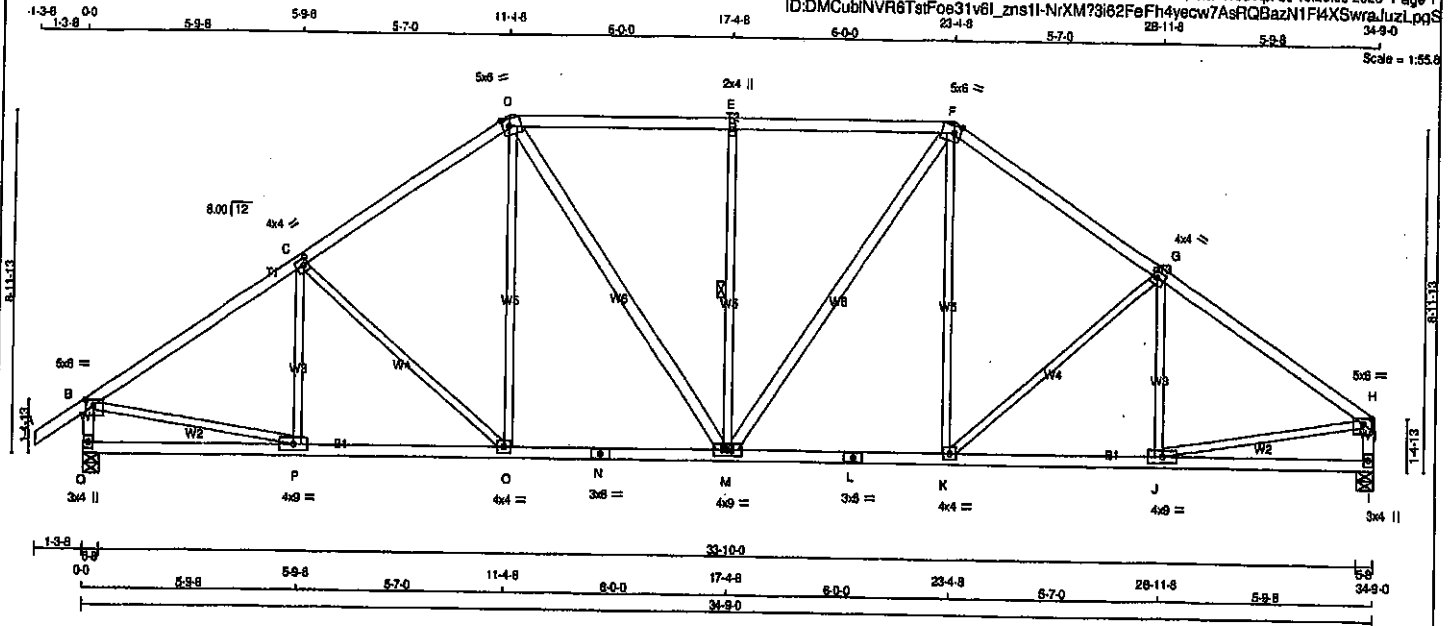

TOTAL WEIGHT = 161 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - F	2x4	DRY	No.2	SPF		
F - H	2x4	DRY	No.2	SPF		
O - B	2x4	DRY	No.2	SPF		
I - H	2x4	DRY	No.2	SPF		
Q - N	2x4	DRY	No.2	SPF		
N - L	2x4	DRY	No.2	SPF		
L - I	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						
D - M	2x4	DRY	No.2	SPF		
M - F	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UPLIFT	IN-SX
Q	2042	0	0	5-8
I	1918	0	0	5-8

UNFACTORED REACTIONS

1ST LOOSE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SC
Q	1441	959 / 0	0 / 0	0 / 0	0 / 0	482 / 0	0 / 0
I	1355	889 / 0	0 / 0	0 / 0	0 / 0	468 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.04 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORZ. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	P-C	-251 / 9
B-C	-2312 / 0	-91.8	-91.8	0.50 (1)	4.04	C-O	-345 / 0
C-D	-2070 / 0	-91.8	-91.8	0.48 (1)	4.26	O-D	0 / 334
D-E	-1988 / 0	-91.8	-91.8	0.49 (1)	4.28	D-M	0 / 476
E-F	-1988 / 0	-91.8	-91.8	0.49 (1)	4.28	M-E	-674 / 0
F-G	-2070 / 0	-91.8	-91.8	0.46 (1)	4.28	M-F	0 / 476
G-H	-2312 / 0	-91.8	-91.8	0.50 (1)	4.04	K-F	0 / 334
H-I	-1988 / 0	0.0	0.0	0.21 (1)	5.97	K-G	-345 / 0
I-H	-1870 / 0	0.0	0.0	0.19 (1)	6.13	J-G	-251 / 9
Q-P	0 / 0	-18.5	-18.5	0.14 (4)	10.00	B-P	0 / 1988
P-O	0 / 1982	-18.5	-18.5	0.38 (1)	10.00	J-H	0 / 1988
O-N	0 / 1895	-18.5	-18.5	0.34 (1)	10.00		
N-M	0 / 1895	-18.5	-18.5	0.34 (1)	10.00		
M-L	0 / 1895	-18.5	-18.5	0.34 (1)	10.00		
L-K	0 / 1895	-18.5	-18.5	0.34 (1)	10.00		
K-J	0 / 1952	-18.5	-18.5	0.38 (1)	10.00		
J-I	0 / 0	-18.5	-18.5	0.14 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE

OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = 1/360 (1.16")

CALCULATED VERT. DEFL. (LL) = 1/999 (0.09")

ALLOWABLE DEFL. (TL) = 1/360 (1.16")

CALCULATED VERT. DEFL. (TL) = 1/999 (0.16")

CSK: TC=0.50/1.00 (G-H:1), BC=0.38/1.00 (O-P:1), WB=0.45/1.00 (H-J:1), SS=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	818	354	1687
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.



JSI GRIP = 0.86 (P) (INPUT = 0.90)

JSI METAL = 0.55 (L) (INPUT = 1.00)



Structural component only
DWG# T-2007886

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Wed Apr 29 16:26:10 2020 Page 1
ID:DMCubINVR6TstFoe3iV6L_zns1I-25KDPkpZm6JEXqAeeP0LzOTMpy_8Vqhab7rKzLpP
-1-3-8 0-0 4-2-3 4-2-3 3-11-11 8-1-13 12-1-6 17-4-8 5-3-0 5-3-0 22-7-8 3-11-11 26-7-3 3-11-11 30-6-13 4-2-3 34-0-0 36-0-8
Scale = 1:57.8



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408312	T5	1	3	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Wed Apr 29 16:28:11 2020 Page 2
ID:DMCubINVR6TstFoe31v6I zns11-JE6CinNasuzwOB1kl9exsVZCm0BiclvEKhtNmzLpgQ

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-m	MT20	6.0	12.0	2.50	5.25
C	TMWW-t	MT20	5.0	6.0	2.25	1.75
D	TS-t	MT20	3.0	6.0		
E	TMWW-t	MT20	4.0	6.0	2.00	2.00
F	TTWW-m	MT20	5.0	6.0	2.25	2.00
G	TMWW-w	MT20	2.0	4.0		
H	TTWW-m	MT20	5.0	6.0	2.25	2.00
I	TMWW-t	MT20	4.0	6.0	2.00	2.00
J	TS-t	MT20	3.0	6.0		
K	TMWW-t	MT20	5.0	6.0	2.25	1.75
L	TMWW-m	MT20	6.0	12.0	2.50	5.25
N	BMV1-p	MT20	6.0	12.0	Edge	1.25
O	BMWW-t	MT20	6.0	9.0	5.50	3.00
P, R, T, V						
P	BMWW-t	MT20	5.0	6.0		
Q	BS-t	MT20	6.0	9.0		
S	BMWWW-t	MT20	5.0	6.0		
U	BS-t	MT20	6.0	9.0		
W	BMWW-t	MT20	6.0	9.0	5.50	3.00
X	BMV1-p	MT20	6.0	12.0	7.25	


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
Z	33-8-4	-1155	-1155	---	BACK	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

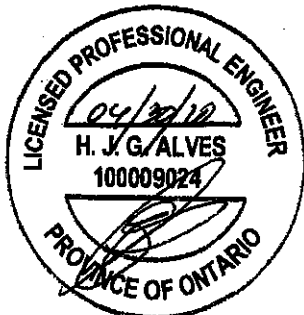

Structural component only
DWG# T-2007887 3/2

JOB NAME 408312	TRUSS NAME T6	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

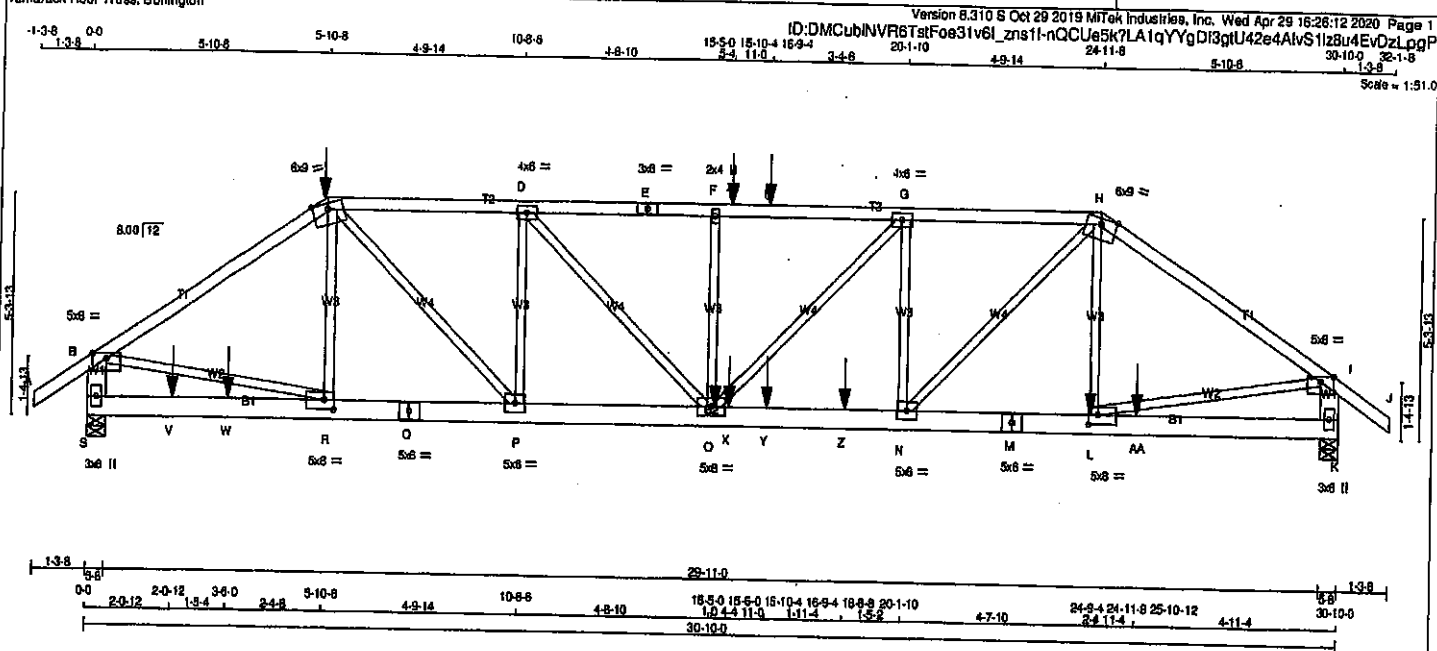

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x8	DRY	No.2
K - I	2x8	DRY	No.2
S - Q	2x8	DRY	No.2
Q - M	2x8	DRY	No.2
M - K	2x8	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY, SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122'x3') SPIRAL NAILS		
A-C	12	SIDE(81.0)
C-E	12	SIDE(81.0)
E-H	12	SIDE(81.0)
H-J	12	SIDE(81.0)
S-B	12	TOP
K-I	12	TOP
BOTTOM CHORDS : (0.122'x3') SPIRAL NAILS		
S-Q	12	SIDE(0.0)
Q-M	12	SIDE(183.1)
M-K	12	SIDE(183.1)
WEBS : (0.122'x3') SPIRAL NAILS		
2x3	6	SIDE(67.7)
F-O	6	SIDE(125.8)
L-H	6	SIDE(125.8)

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	VERT	UPLIFT	IN-SX
S	4524	4524	0	5-8
K	5309	5309	0	5-8

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
S	3186	2187 / 0
K	3741	2530 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.13 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	WEBS	MAX. FACTORED MEMB. FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO					FR-TO		
A-B	0 / 35	-91.8	-91.8	0.07 (1)	R-C	0 / 219	0.03 (4)
B-C	-5414 / 0	-91.8	-91.8	0.59 (1)	C-P	0 / 2740	0.34 (1)
C-D	-6421 / 0	-91.8	-91.8	0.34 (1)	P-D	-2137 / 0	0.43 (1)
D-E	-8028 / 0	-91.8	-91.8	0.45 (1)	D-O	0 / 2328	0.28 (1)
E-F	-8028 / 0	-91.8	-91.8	0.45 (1)	O-F	-713 / 0	0.14 (1)
F-T	-8028 / 0	-91.8	-91.8	0.49 (1)	T-G	0 / 715	0.09 (1)
T-U	-8028 / 0	-91.8	-91.8	0.49 (1)	U-G	-1081 / 0	0.22 (1)
U-G	-8028 / 0	-91.8	-91.8	0.49 (1)	G-H	0 / 2008	0.33 (1)
G-H	-7535 / 0	-91.8	-91.8	0.48 (1)	H-I	0 / 1404	0.17 (1)
H-I	-6785 / 0	-91.8	-91.8	0.74 (1)	I-J	0 / 4582	0.50 (1)
I-J	0 / 35	-91.8	-91.8	0.07 (1)	J-K	0 / 5717	0.71 (1)
S-B	-4158 / 0	0.0	0.0	0.15 (1)			
K-I	-5109 / 0	0.0	0.0	0.18 (1)			
S-V	0 / 0	-18.5	-18.5	0.41 (1)			
V-W	0 / 0	-18.5	-18.5	0.41 (1)			
W-R	0 / 0	-18.5	-18.5	0.41 (1)			
R-Q	0 / 4504	-18.5	-18.5	0.53 (1)			
Q-P	0 / 4504	-18.5	-18.5	0.53 (1)			
P-O	0 / 6421	-18.5	-18.5	0.50 (1)			
O-X	0 / 7535	-18.5	-18.5	0.82 (1)			
X-Y	0 / 7535	-18.5	-18.5	0.82 (1)			
Y-Z	0 / 7535	-18.5	-18.5	0.82 (1)			
Z-N	0 / 7535	-18.5	-18.5	0.82 (1)			
N-M	0 / 5688	-18.5	-18.5	0.50 (1)			
M-L	0 / 5688	-18.5	-18.5	0.50 (1)			
L-AA	0 / 0	-18.5	-18.5	0.28 (1)			
AA-K	0 / 0	-18.5	-18.5	0.28 (1)			

FACTORED CONCENTRATED LOADS (LBS)	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
JT	5-10-8	-361	-361	---	BACK	VERT	---	C1
C	24-9-4	-1184	-1184	---	BACK	VERT	---	C1
L	15-8-0	-961	-961	---	BACK	VERT	---	C1
O	15-10-4	-178	-178	---	BACK	VERT	---	C1
T	18-9-4	-178	-178	---	BACK	VERT	---	C1
U	2-0-12	-36	-36	---	BACK	VERT	---	C1
V	3-6-0	-961	-961	---	BACK	VERT	---	C1
W	15-10-4	-36	-36	---	BACK	VERT	---	C1
X	16-9-4	-36	-36	---	BACK	VERT	---	C1
Y	18-8-8	-1087	-1087	---	BACK	VERT	---	C1
Z	25-10-12	-1184	-1184	---	BACK	VERT	---	C1

TOTAL WEIGHT = 2 X 149 = 298 LB

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, OBC 2012, ABC 2019

- PART 9 OF OBC 2012 (2019 AMENDMENT)

- CSA 088-09, CSA 088-14

- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03')

CALCULATED VERT. DEFL.(LL) = L/899 (0.19')

ALLOWABLE DEFL.(TL) = L/360 (1.03')

CALCULATED VERT. DEFL.(TL) = L/899 (0.34')

CSI: TC=0.74/1.00 (H:I), BC=0.82/1.00 (N:C),

WB=0.71/1.00 (L:L), SS=0.38/1.00 (K:L)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PL) (PL)

MAX MIN MAX MIN MAX MIN

MT20 616 354 1967 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (E) (INPUT = 0.80)

JSI METAL = 0.62 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007888

JOB NAME 408312	TRUSS NAME T6	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Wed Apr 29 18:28:12 2020 Page 2
ID:DMCubINVR8TslF0e31v6l zns1l-nOCUa5k?LA1qYYgDl3qlU42e4AlvS1z8u4EvDzLogP

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW-m	MT20	6.0	9.0	Edge	
D	TMWW-t	MT20	4.0	6.0		
E	TS-t	MT20	3.0	6.0		
F	TMW-w	MT20	2.0	4.0		
G	TMWW-t	MT20	4.0	6.0		
H	TTWW-m	MT20	6.0	9.0	Edge	
I	TMVW-p	MT20	5.0	8.0	Edge	
K	BMV1-p	MT20	3.0	6.0		
L	BMWW-t	MT20	5.0	8.0	2.75	2.75
M	BS-t	MT20	5.0	8.0		
N	BMWW-t	MT20	5.0	8.0		
O	BMWWW-t	MT20	5.0	8.0		
P	BMWW-t	MT20	5.0	8.0		
Q	BS-t	MT20	5.0	8.0		
R	BMWW-t	MT20	5.0	8.0	2.75	2.75
S	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007888 2/2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
<u>BEARINGS</u>							
DESCR.	FACTORED			MAXIMUM FACTORED		INPUT	REQ'D
SPF	GROSS REACTION			GROSS REACTION		BRG	BRG
SPF	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
SPF	P	1828	0	1828	0	0	5-8
SPF	J	1828	0	1828	0	0	5-8
SPF							
SPF							
SPF							
<u>UNFACTORED REACTIONS</u>							
	1ST LCASE		MAX. MIN. COMPONENT REACTIONS				
SPF	JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
	P	1289	858 / 0	0 / 0	0 / 0	0 / 0	430 / 0
SPF	J	1289	859 / 0	0 / 0	0 / 0	0 / 0	430 / 0
SPF							

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J


BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.55 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WESS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LOAD LGT (LC)	MAX. UNBRAC LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)		
FR-TO		FROM TO			FR-TO				
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	C-O	-8 / 52	0.02 (4)	
B-C	0 / 22	-91.8	-91.8	0.22 (1)	10.00	D-D	0 / 170	0.05 (4)	
C-D	-1934 / 0	-91.8	-91.8	0.21 (1)	4.88	D-M	0 / 758	0.17 (1)	
D-E	-2169 / 0	-91.8	-91.8	0.80 (1)	3.55	M-E	-852 / 0	0.82 (1)	
E-F	-2169 / 0	-91.8	-91.8	0.80 (1)	3.55	M-F	0 / 758	0.17 (1)	
F-G	-1934 / 0	-91.8	-91.8	0.21 (1)	4.86	K-F	0 / 170	0.05 (4)	
G-H	0 / 22	-91.8	-91.8	0.22 (1)	10.00	K-G	-8 / 52	0.02 (4)	
H-I	0 / 35	-91.8	-91.8	0.12 (1)	10.00	P-C	-2188 / 0	0.74 (1)	
I-J	-268 / 0	0.0	0.0	0.03 (1)	7.81	G-J	-2188 / 0	0.74 (1)	
J-H	-268 / 0	0.0	0.0	0.03 (1)	7.81				
P-O	0 / 1593	-18.5	-18.5	0.41 (1)	10.00				
O-N	0 / 1591	-18.5	-18.5	0.42 (4)	10.00				
N-M	0 / 1591	-18.5	-18.5	0.42 (4)	10.00				
M-L	0 / 1591	-18.5	-18.5	0.42 (4)	10.00				
L-K	0 / 1591	-18.5	-18.5	0.42 (4)	10.00				
K-J	0 / 1593	-18.5	-18.5	0.41 (1)	10.00				

JSI GRIP= 0.83 (G) (INPUT = 0.90)
JSI METAL= 0.58 (L) (INPUT = 1.00)



Version 8.310 S Oct 29 2019 MITek Industries, Inc. Wed Apr 29 16:28:14 2020 Page 1
ID:DMCubInVR6TstF0e31y6l_zns1l-kcKF2n1FmHYNrq6PTJLZV73p_53wxWGc8ZL_5zLpgN
20-11-8 10-10-8 25-9-8 30-10-8 30-1-8
1-3-8 0-0 5-0-8 15-5-0 5-6-8 5-6-8 5-0-8
1-3-8 5-0-8 10-0-8 5-6-8 5-6-8 5-0-8
Scale = 1:51.0

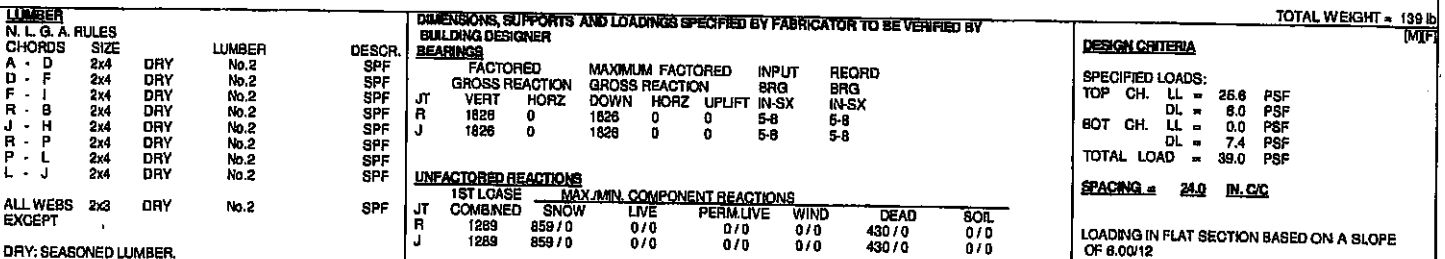

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

FACTORED GROSS REACTION			MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQ'D BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
R	1828	0	1828	0	0	5-8	5-8
J	1826	0	1828	0	0	5-8	5-8

1ST LOASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1289	859 / 0	0 / 0	0 / 0	0 / 0	430 / 0	0 / 0
J	1289	859 / 0	0 / 0	0 / 0	0 / 0	430 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R. J.

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

TOTAL LOAD CASES: (4)

CHORDS				WEBBS				
MAX. FACTORED		FACTORED		MAX. FACTORED		WEBBS		
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	CGI (LC)	MAX. UNBRAC	MEMB.	FORCE (LBS)	MAX. CGI (LC)	
FR-TO		FROM TO		LENGTH	FR-TO			
A-B	0/35	-91.8	-91.8	0.12 (1)	10.00	Q-C	-284 / 0	0.09 (1)
B-C	-1690 / 0	-91.8	-91.8	0.35 (1)	4.47	C-O	-258 / 0	0.21 (1)
C-D	-1622 / 0	-91.8	-91.8	0.33 (1)	4.84	C-D	0 / 271	0.08 (1)
D-E	-1752 / 0	-91.8	-91.8	0.40 (1)	4.81	D-N	0 / 445	0.10 (1)
E-F	-1752 / 0	-91.8	-91.8	0.40 (1)	4.81	N-E	-621 / 0	0.75 (1)
F-G	-1822 / 0	-91.8	-91.8	0.35 (1)	4.84	N-F	0 / 445	0.10 (1)
G-H	-1990 / 0	-91.8	-91.8	0.35 (1)	4.47	M-F	0 / 271	0.08 (1)
H-I	0/35	0.0	-91.8	0.12 (1)	10.00	M-G	-258 / 0	0.21 (1)
R-B	-1785 / 0	-91.8	0.0	0.18 (1)	5.28	K-Q	-284 / 0	0.09 (1)
J-H	-1785 / 0	0.0	0.0	0.18 (1)	5.28	B-K	0 / 1718	0.39 (1)
						K-H	0 / 1718	0.39 (1)
FR-Q	0/0	-18.5	-18.5	0.10 (4)	10.00			
Q-P	0/1680	-18.5	-18.5	0.33 (1)	10.00			
P-O	0/1680	-18.5	-18.5	0.33 (1)	10.00			
O-N	0/1492	-18.5	-18.5	0.30 (1)	10.00			
N-M	0/1492	-18.5	-18.5	0.30 (1)	10.00			
M-L	0/1680	-18.5	-18.5	0.33 (1)	10.00			
L-K	0/1680	-18.5	-18.5	0.33 (1)	10.00			
K-J	0/0	-18.5	-18.5	0.10 (4)	10.00			

SPECIFIED LOADS:				
TOP	CH.	LL =	25.6	PSF
		DL =	6.0	PSF
BOT	CH.	LL =	0.0	PSF
		DL =	7.4	PSF
TOTAL LOAD =			39.0	PSF

SPACING in 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.03")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.07")
ALLOWABLE DEFL.(TL) = $L/360$ (1.03")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.14")

CSI: TC=0.40/1.00 (D-E:1), BC=0.33/1.00 (K-M:1),
WB=0.75/1.00 (E-N:1), SSI=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)	(PLI)	(PLI)	(PLI)	(PLI)	(PLI)
MT20	818	354	1867	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (B) (INPUT = 0.90)
JSI METAL= 0.48 (L) (INPUT = 1.00)



Structural component only
DWG# T-2007890

JOB NAME 408312	TRUSS NAME IT9	QUANTITY 7	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

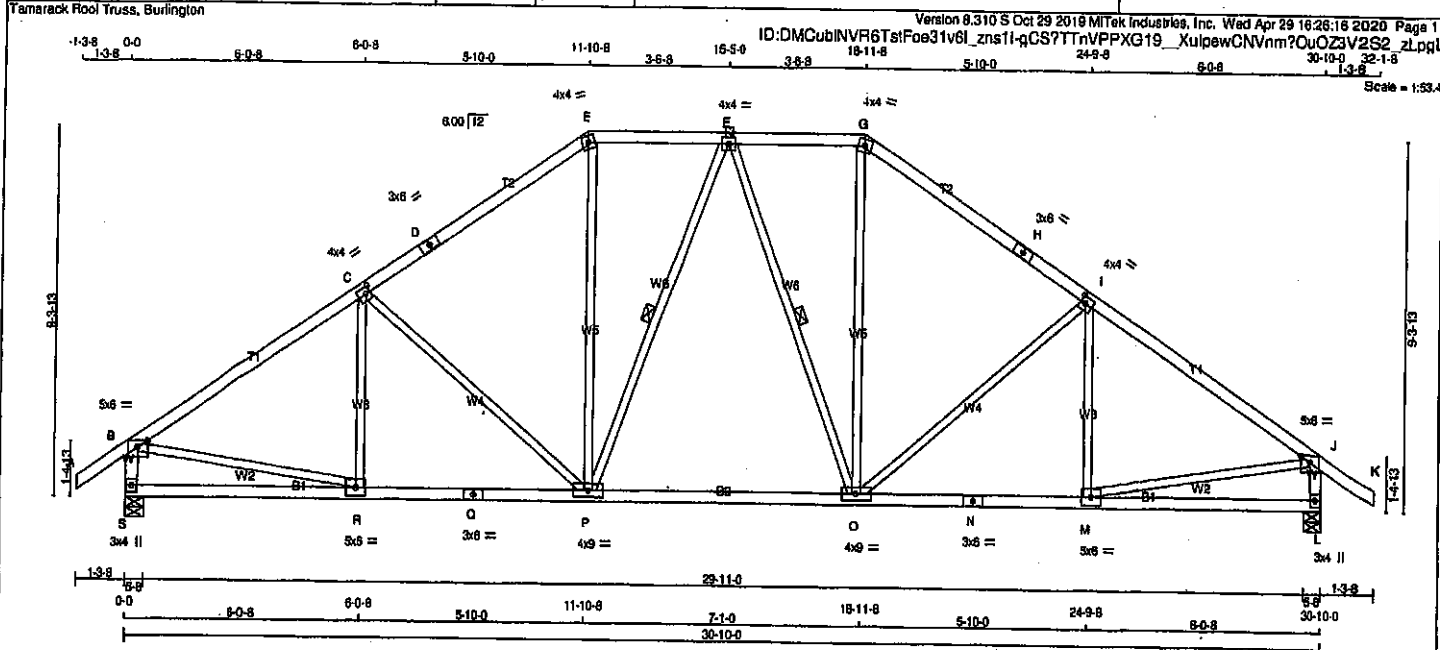

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR
A - D	2x4	DRY	No.2		SPF
D - E	2x4	DRY	No.2		SPF
E - G	2x4	DRY	No.2		SPF
G - H	2x4	DRY	No.2		SPF
H - K	2x4	DRY	No.2		SPF
S - B	2x4	DRY	No.2		SPF
L - J	2x4	DRY	No.2		SPF
S - Q	2x4	DRY	No.2		SPF
Q - N	2x4	DRY	No.2		SPF
N - L	2x4	DRY	No.2		SPF
ALL WEBS		2x3	DRY	No.2	SPF
EXCEPT					
DRY: SEASONED LUMBER.					

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge	
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TS-1	MT20	3.0	8.0		
E	TTW-m	MT20	4.0	4.0		
F	TMVW-t	MT20	4.0	4.0		
G	TTW-m	MT20	4.0	4.0		
H	TS-1	MT20	3.0	8.0		
I	TMVW-t	MT20	4.0	4.0	2.00	1.50
J	TMVW-p	MT20	5.0	6.0	Edge	
L	BMV1-p	MT20	3.0	4.0		
M	BMVW-t	MT20	5.0	6.0		
N	BS-1	MT20	3.0	6.0		
O	BMVW-t	MT20	4.0	8.0		
P	BMVW-t	MT20	4.0	8.0		
Q	BS-1	MT20	3.0	6.0		
R	BMVW-t	MT20	5.0	6.0		
S	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	0	0
S	HORZ	HORZ	0	0
L		UPLIFT	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1289	859 / 0	0 / 0	0 / 0	0 / 0	430 / 0	0 / 0
L	1289	859 / 0	0 / 0	0 / 0	0 / 0	430 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.24 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-P, F-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	LC1 MAX (LC)	UNBRACED LENGTH	
FR-TO					FR-TO				
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	R-C	-187 / 32	0.08 (1)	
B-C	-2011 / 0	-91.8	-91.8	0.52 (1)	4.24	C-P	-426 / 0	0.54 (1)	
C-D	-1898 / 0	-91.8	-91.8	0.48 (1)	4.58	P-E	0 / 590	0.13 (1)	
D-E	-1898 / 0	-91.8	-91.8	0.48 (1)	4.58	P-F	-205 / 0	0.14 (1)	
E-F	-1387 / 0	-91.8	-91.8	0.15 (1)	5.38	F-O	-205 / 0	0.14 (1)	
F-G	-1387 / 0	-91.8	-91.8	0.15 (1)	5.38	O-G	0 / 590	0.13 (1)	
G-H	-1898 / 0	-91.8	-91.8	0.48 (1)	4.58	O-I	-426 / 0	0.54 (1)	
H-I	-1898 / 0	-91.8	-91.8	0.48 (1)	4.58	M-I	-187 / 32	0.08 (1)	
I-J	-2011 / 0	-91.8	-91.8	0.52 (1)	4.24	B-R	0 / 1730	0.39 (1)	
J-K	0 / 35	-91.8	-91.8	0.12 (1)	10.00	M-J	0 / 1730	0.39 (1)	
S-B	-1778 / 0	0.0	0.0	0.18 (1)	6.28				
L-J	-1778 / 0	0.0	0.0	0.18 (1)	6.28				
S-R	0 / 0	-18.5	-18.5	0.14 (4)	10.00				
R-Q	0 / 1703	-18.5	-18.5	0.36 (1)	10.00				
O-P	0 / 1703	-18.5	-18.5	0.36 (1)	10.00				
P-O	0 / 1480	-18.5	-18.5	0.32 (1)	10.00				
O-N	0 / 1703	-18.5	-18.5	0.36 (1)	10.00				
N-M	0 / 1703	-18.5	-18.5	0.36 (1)	10.00				
M-L	0 / 0	-18.5	-18.5	0.14 (4)	10.00				

TOTAL WEIGHT = 7 X 141 = 988 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(56% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CSI: TC=0.52/1.00 (H:1), BC=0.38/1.00 (M:0:1), WB=0.54/1.00 (FO:1), SS=0.22/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	918	354
	1887	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 9.0 Deg.

JSI GRIP = 0.88 (J) (INPUT = 0.80)
JSI METAL = 0.54 (N) (INPUT = 1.00)




Structural component only
DWG# T-2007891

JOB NAME 408312	TRUSS NAME T11	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Wed Apr 29 16:26:17 2020 Page 1

ID:DMCubINVR6TstF0e31v6L_zns11-800Nho07Aif7eJZA4cG2A7iWVB6y7LMi9n7bQzLpgK

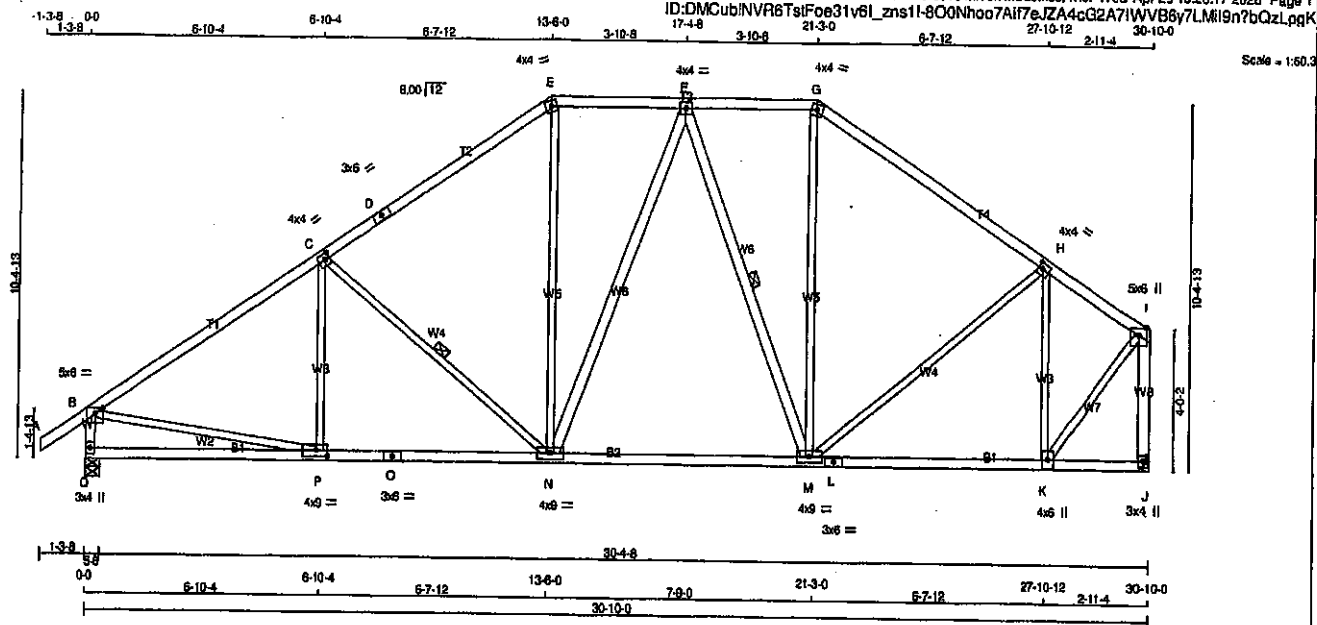

Scale = 1/80.0

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
J - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - N	2x4	DRY	No.2
N - O	2x4	DRY	No.2
O - P	2x4	DRY	No.2
P - Q	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
N - F	2x4	DRY	No.2
F - M	2x4	DRY	No.2

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	6.0	Edge
C	TMVW-t	MT20	4.0	4.0	2.00 1.50
D	TS-I	MT20	3.0	8.0	
E	TTW-m	MT20	4.0	4.0	
F	TMVW-t	MT20	4.0	4.0	
G	TTW-m	MT20	4.0	4.0	
H	TMVW-t	MT20	4.0	4.0	2.00 1.50
I	TMVW-p	MT20	5.0	6.0	Edge
J	BMV1-p	MT20	3.0	4.0	
K	BMVW-t	MT20	4.0	6.0	
L	BS-I	MT20	3.0	6.0	
M	BMVW-t	MT20	4.0	6.0	
N	BMVW-t	MT20	4.0	6.0	
O	BS-I	MT20	3.0	6.0	
P	BMVW-t	MT20	4.0	6.0	2.00 4.00
Q	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED DOWN BRG	INPUT UPLIFT IN-SX	REQD BRG IN-SX
JT	VERT	HORZ		
Q	1828	0	1828	0
J	1700	0	1700	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
Q	1289	859 / 0	0 / 0	0 / 0	0 / 0	430 / 0	0 / 0
J	1202	789 / 0	0 / 0	0 / 0	0 / 0	413 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, F-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	P-C	-133 / 65	0.07 (1)
B-C	-2010 / 0	-91.8	-91.8 0.89 (1)	3.89	C-N	-558 / 0	0.30 (1)
C-D	-1584 / 0	-91.8	-91.8 0.82 (1)	4.47	N-E	0 / 487	0.11 (1)
D-E	-1584 / 0	-91.8	-91.8 0.82 (1)	4.47	E-F	0 / 37	0.01 (4)
E-F	-1288 / 0	-91.8	-91.8 0.18 (1)	5.50	F-M	-458 / 0	0.28 (1)
F-G	-1125 / 0	-91.8	-91.8 0.18 (1)	5.79	M-G	0 / 360	0.08 (1)
G-H	-1381 / 0	-91.8	-91.8 0.54 (1)	4.87	M-H	0 / 325	0.07 (1)
H-I	-979 / 0	-91.8	-91.8 0.40 (1)	5.76	K-H	-999 / 0	0.58 (1)
Q-B	-1773 / 0	0.0	0.0 0.18 (1)	6.27	B-P	0 / 1728	0.39 (1)
J-I	-1887 / 0	0.0	0.0 0.45 (1)	6.39	K-I	0 / 1401	0.32 (1)
Q-P	0 / 0	-18.5	-18.5 0.20 (4)	10.00			
P-O	0 / 1707	-18.5	-18.5 0.38 (1)	10.00			
O-N	0 / 1707	-18.5	-18.5 0.38 (1)	10.00			
N-M	0 / 1286	-18.5	-18.5 0.32 (1)	10.00			
M-L	0 / 873	-18.5	-18.5 0.28 (4)	10.00			
L-K	0 / 873	-18.5	-18.5 0.28 (4)	10.00			
K-J	0 / 0	-18.5	-18.5 0.11 (4)	10.00			

TOTAL WEIGHT = 154 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.69/1.00 (B-C:1), BC=0.38/1.00 (N-P:1), WB=0.58/1.00 (H-K:1), SS=0.25/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PU)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (H) (INPUT = 0.99)
JSI METAL = 0.53 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007892

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408312	T12	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Wed Apr 29 18:28:19 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zn1811-4n788UpOIKYrudZC1IWGYogG37nibFK7TtG6IJzLpgl

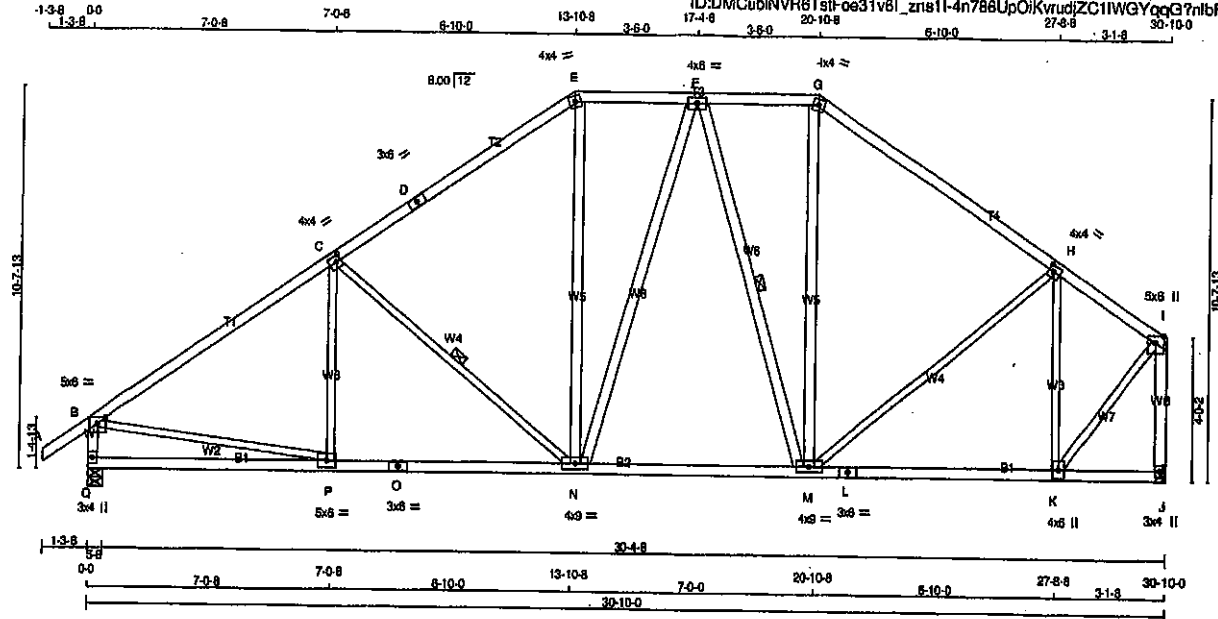

TOTAL WEIGHT = 2 X 183 = 366 lb (MIP)

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
N - E	2x4	DRY	No.2
N - F	2x4	DRY	No.2
F - M	2x4	DRY	No.2
M - G	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0	6.0 Edge
C	TMVW-t	MT20	4.0	4.0 2.00 1.50
D	TS-I	MT20	3.0	6.0
E	TTW-m	MT20	4.0	4.0
F	TMVW-t	MT20	4.0	6.0
G	TTW-m	MT20	4.0	4.0
H	TMVW-t	MT20	4.0	4.0 2.00 1.50
I	TMVW-p	MT20	5.0	6.0 Edge
J	BMV1-p	MT20	3.0	4.0
K	BMVW-t	MT20	4.0	6.0
L	BS-I	MT20	3.0	6.0
M	BMVW-t	MT20	4.0	6.0
N	BMVW-t	MT20	4.0	6.0
O	BS-I	MT20	3.0	6.0
P	BMVW-t	MT20	5.0	6.0
Q	BMV1-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	GROSS REACTION	DOWN	UP	BRG	BRG	IN-SX
Q	1826	0	1826	0	5-8	5-8	MECHANICAL
J	1700	0	1700	0	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3'-8".

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
Q	1289	859 / 0	0 / 0	0 / 0	0 / 0	430 / 0	0 / 0
J	1202	789 / 0	0 / 0	0 / 0	0 / 0	413 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.92 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, F-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	UNBRACED LENGTH FR-TO
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	P-C	-118 / 76	0.07 (1)
B-C	-2009 / 0	-91.8	-91.8 0.74 (1)	3.92	C-N	-588 / 0	0.33 (1)
C-D	-1552 / 0	-91.8	-91.8 0.68 (1)	4.43	N-E	0 / 475	0.08 (1)
D-E	-1552 / 0	-91.8	-91.8 0.68 (1)	4.43	N-F	0 / 40	0.01 (4)
E-F	-1261 / 0	-91.8	-91.8 0.15 (1)	5.58	F-M	-427 / 0	0.28 (1)
F-G	-1121 / 0	-91.8	-91.8 0.15 (1)	5.83	M-G	0 / 362	0.08 (1)
G-H	-1375 / 0	-91.8	-91.8 0.57 (1)	4.82	M-H	0 / 277	0.06 (1)
H-I	-1018 / 0	-91.8	-91.8 0.42 (1)	5.63	K-H	-980 / 0	0.56 (1)
I-J	-1772 / 0	0.0	0.0 0.18 (1)	6.27	B-P	0 / 1727	0.39 (1)
J-K	-1687 / 0	0.0	0.0 0.45 (1)	6.39	K-I	0 / 1398	0.31 (1)
Q-P	0 / 0	-18.5	-18.5 0.22 (4)	10.00			
P-O	0 / 1707	-18.5	-18.5 0.39 (1)	10.00			
O-N	0 / 1707	-18.5	-18.5 0.39 (1)	10.00			
N-M	0 / 1253	-18.5	-18.5 0.30 (1)	10.00			
M-L	0 / 803	-18.5	-18.5 0.28 (4)	10.00			
L-K	0 / 803	-18.5	-18.5 0.26 (4)	10.00			
K-J	0 / 0	-18.5	-18.5 0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CS1: TC=0.74/1.00 (B-C:1), BC=0.38/1.00 (N-P:1),
WB=0.58/1.00 (H-K:1), SB=0.26/1.00 (B-C:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (B) (INPUT = 0.90)
JSI METAL= 0.52 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007893

JOB NAME	TRUSS NAME	QUANTITY	PLV	JOB DESC.	DRWG NO.
408312	T13S	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Wed Apr 29 16:28:20 2020 Page 1
ID:DMCubINVR6Tsf0e831v6l_zns11-YzhWJqoTd1hVmlmkqlomN8cO7QKrm08_70ICzLpgH

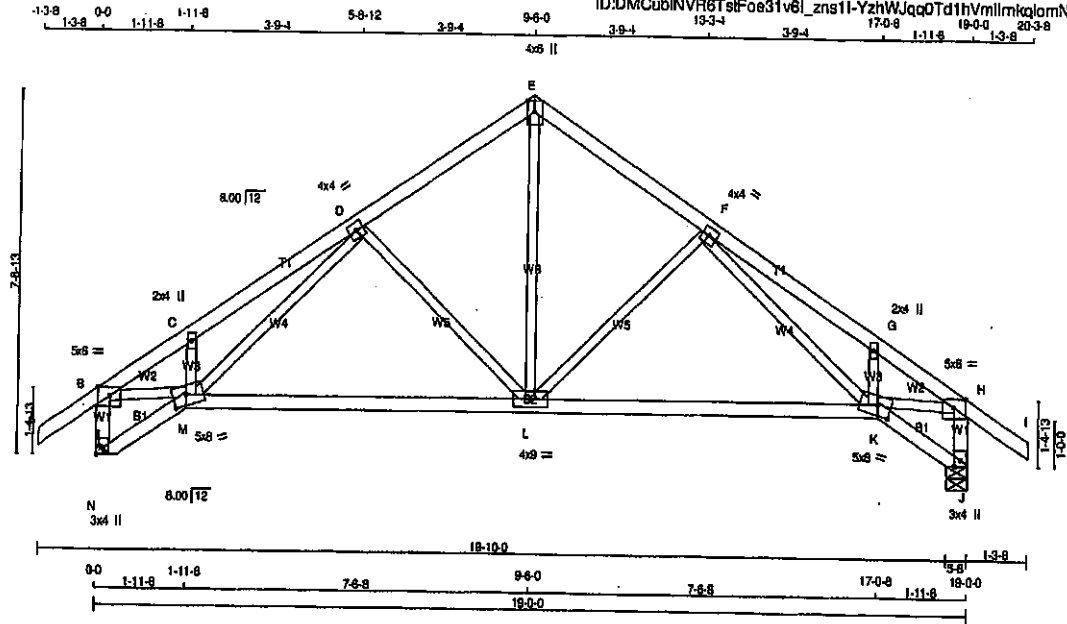

Scale = 1:48.2

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
N - B	2x4	DRY	No.2
A - E	2x4	DRY	No.2
E - I	2x4	DRY	No.2
J - H	2x4	DRY	No.2
N - M	2x4	DRY	No.2
M - K	2x4	DRY	No.2
K - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			SPF

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	6.0	Edge
O	TMVW-w	MT20	2.0	4.0	
D	TMVW-t	MT20	4.0	4.0	
E	TTW-p	MT20	4.0	6.0	Edge
F	TMVW-t	MT20	4.0	4.0	
G	TMVW-w	MT20	2.0	4.0	
H	TMVW-p	MT20	5.0	6.0	Edge
J	BMV1-p	MT20	3.0	4.0	Edge
K	BBWW-w	MT20	5.0	8.0	2.75 3.50
L	BBWW-t	MT20	4.0	9.0	
M	BBWW-w	MT20	5.0	8.0	2.75 3.50
N	BMV1-p	MT20	3.0	4.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	DOWN	HORZ	UP/LIFT	IN-SX	BRG	IN-SX
N	1173	0	1173	0	0	0	5-8	5-8	
J	1173	0	1173	0	0	0	5-8	5-8	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT N. MINIMUM BEARING LENGTH AT JOINT N = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
N	827	558 / 0	0 / 0	0 / 0	0 / 0	271 / 0	0 / 0
J	827	558 / 0	0 / 0	0 / 0	0 / 0	271 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.04 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO		FR-TO			
N-B	-1155 / 0	0.0	0.0 0.12 (1)	7.40	L-E	0 / 781	0.18 (1)
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	L-F	-437 / 0	0.22 (1)
B-C	-1621 / 0	-91.8	-91.8 0.07 (1)	5.15	F-K	0 / 361	0.08 (1)
C-D	-1610 / 0	-91.8	-91.8 0.19 (1)	5.04	K-G	-232 / 0	0.03 (1)
D-E	-977 / 0	-91.8	-91.8 0.17 (1)	8.11	K-H	0 / 1353	0.30 (1)
E-F	-977 / 0	-91.8	-91.8 0.17 (1)	8.11	D-L	-437 / 0	0.22 (1)
F-G	-1610 / 0	-91.8	-91.8 0.19 (1)	5.04	M-D	0 / 361	0.08 (1)
G-H	-1621 / 0	-91.8	-91.8 0.07 (1)	5.15	M-C	-232 / 0	0.03 (1)
H-I	0 / 35	-91.8	-91.8 0.12 (1)	10.00	B-M	0 / 1353	0.30 (1)
J-H	-1155 / 0	0.0	0.0 0.12 (1)	7.40			
N-M	0 / 0	-18.5	-18.5 0.02 (4)	10.00			
M-L	0 / 1107	-18.5	-18.5 0.39 (4)	10.00			
L-K	0 / 1107	-18.5	-18.5 0.39 (4)	10.00			
K-J	0 / 0	-18.5	-18.5 0.02 (4)	10.00			

TOTAL WEIGHT = 2 X 81 = 162 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
BOT CH. LL = 8.0 PSF
DL = 0.0 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.63")
CALCULATED VERT. DEFL. (LL) = L/899 (0.04")
ALLOWABLE DEFL. (TL) = L/360 (0.63")
CALCULATED VERT. DEFL. (TL) = L/999 (0.13")

CSI: TC=0.19/1.00 (C-D:1), BC=0.38/1.00 (K-L:4), WB=0.30/1.00 (B-M:1), SS=0.14/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.70 (L) (INPUT = 0.80)
JSI METAL= 0.37 (N) (INPUT = 1.00)




Structural component only
DWG# T-2007894

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408312	T14	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Wed Apr 29 16:28:21 2020 Page 1
ID:DMCub/NVR6TstFoe31v6L_zns1I-09FuXAreEx9Y7wsyJRL_LzwG4oW734NIDnDKBzLpgG

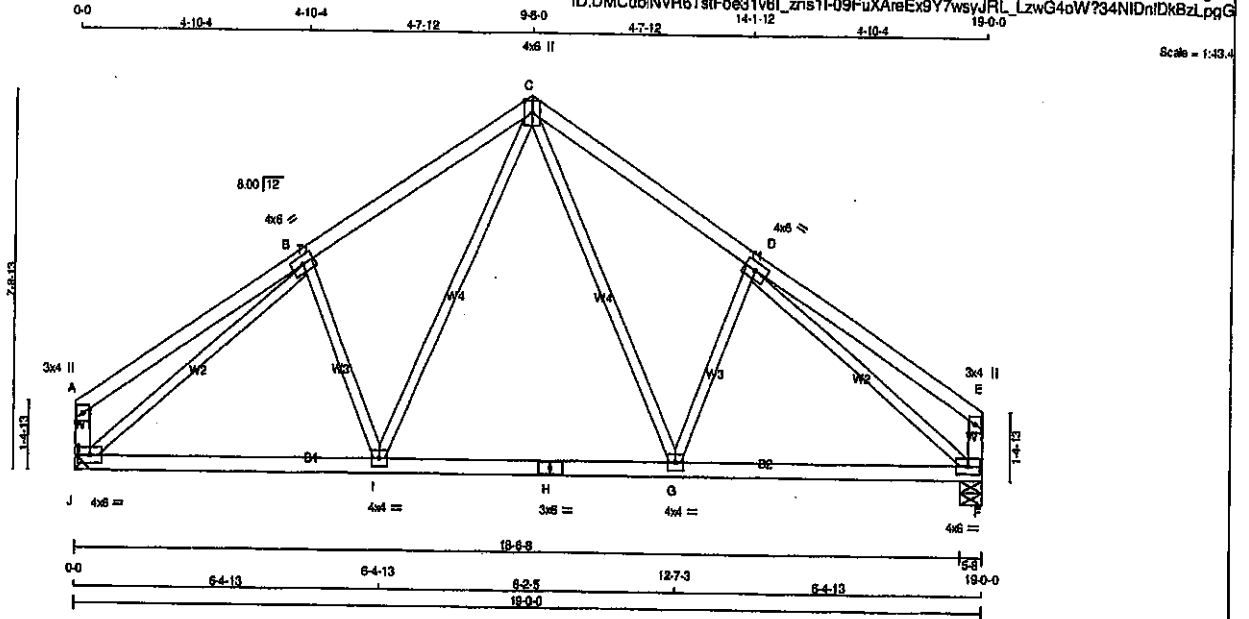

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
J - A	2x4	DRY	No.2
F - E	2x4	DRY	No.2
J - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (tablets in inches)				
JT TYPE	PLATES	W	LEN	Y X
A	TMV+p	MT20	3.0	4.0
B	TMWW-i	MT20	4.0	6.0
C	TTWW+p	MT20	4.0	6.0
D	TMWW-i	MT20	4.0	6.0
E	TMV+p	MT20	3.0	4.0
F	BMWW-i	MT20	4.0	6.0
G	BMWW-i	MT20	4.0	4.0
H	BS-i	MT20	3.0	6.0
I	BMWW-i	MT20	4.0	4.0
J	BMWW-i	MT20	4.0	6.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT		RECORD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	BRG	BRG	IN-SX	IN-SX
J	1047	0	1047	0	0	MECHANICAL			
F	1047	0	1047	0	0	5-8	5-8		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	741	488 / 0	0 / 0	0 / 0	0 / 0	255 / 0	0 / 0	0 / 0
F	741	488 / 0	0 / 0	0 / 0	0 / 0	255 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.87 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.
FR-TO				FR-TO			
A-B	0 / 29	-91.8	10.00	C-G	0 / 418	10.00	
B-C	-1024 / 0	-91.8	10.00	G-D	-277 / 0	10.00	
C-D	-1024 / 0	-91.8	10.00	D-E	0 / 418	10.00	
D-E	0 / 29	-91.8	10.00	E-F	-277 / 0	10.00	
F-A	-185 / 0	0.0	10.00	F-G	-1249 / 0	10.00	
F-E	-185 / 0	0.0	10.00	G-H	-1249 / 0	10.00	
J-I	0 / 931	-18.5	10.00	H-G	0 / 931	10.00	
I-H	0 / 931	-18.5	10.00	G-F	0 / 931	10.00	
H-G	0 / 931	-18.5	10.00				
G-F	0 / 931	-18.5	10.00				

TOTAL WEIGHT = 80 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.83")
CALCULATED VERT. DEFL. (LL) = L/999 (0.03")
ALLOWABLE DEFL. (TL) = L/360 (0.83")
CALCULATED VERT. DEFL. (TL) = L/999 (0.07")

CSI: TC=0.34/1.00 (A-B:1), BC=0.24/1.00 (H-J:4), WB=0.87/1.00 (B-J:1), SSI=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(FS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (D) (INPUT = 0.99)
JSI METAL = 0.92 (D) (INPUT = 1.00)




Structural component only
DWG# T-2007895

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408312	T15	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 12:06:42 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns11-vy19IKwAnht5bTAbdQnAhc_UAXg1DWXTeoFwozLYNn

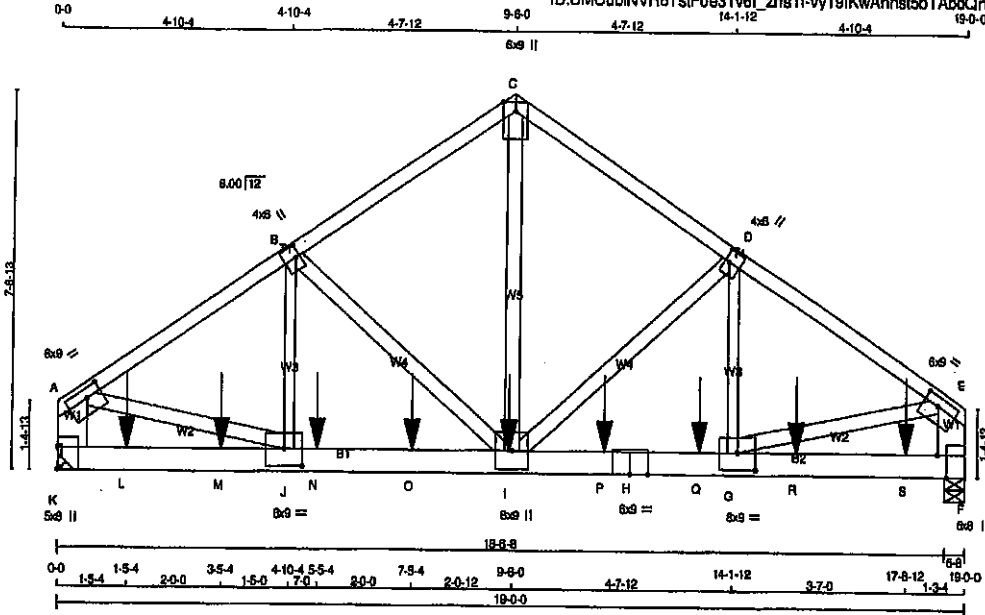

Scale = 1:43.4

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DRY
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
K - A	2x8	DRY	No.2
F - E	2x8	DRY	No.2
K - H	2x8	DRY	2100F 1.8E
H - F	2x8	DRY	2100F 1.8E
ALL WEBS EXCEPT	2x4	DRY	No.2
G - D	2x3	DRY	No.2
J - B	2x3	DRY	No.2

DRY, SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
C - E	12	TOP
K - A	12	TOP
F - E	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
K - H	12	SIDE (197.8)
H - F	12	SIDE (0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	8	SIDE (273.7)
1-C	8	
2x4	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
K	8890	0	0	8890	0	0	0	IN-SX	IN-SX
F	8091	0	0	8091	0	0	0	MECHANICAL	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT K, MINIMUM BEARING LENGTH AT JOINT K = 4-0.

UNFACTORED REACTIONS

1ST CASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	8276	4189 / 0	0 / 0	0 / 0	0 / 0	2068 / 0	0 / 0
F	8412	4304 / 0	0 / 0	0 / 0	0 / 0	2109 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.67 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO	
A-B	-10082 / 0	-91.8	-91.8 0.70 (1)	1-C	0 / 8089
B-C	-7630 / 0	-91.8	-91.8 0.43 (1)	1-D	-2920 / 0
C-D	-7630 / 0	-91.8	-91.8 0.43 (1)	3-G	0 / 2888
D-E	-10185 / 0	-91.8	-91.8 0.72 (1)	B-1	-2804 / 0
K-A	-7518 / 0	0.0	0.0 0.21 (1)	J-B	0 / 2783
F-E	-7591 / 0	0.0	0.0 0.21 (1)	A-J	0 / 8580
				G-E	0 / 8667
K-L	0 / 0	-18.5	-18.5 0.39 (1)		
L-M	0 / 0	-18.5	-18.5 0.39 (1)		
M-J	0 / 0	-18.5	-18.5 0.39 (1)		
J-N	0 / 8405	-18.5	-18.5 0.58 (1)		
N-O	0 / 8405	-18.5	-18.5 0.58 (1)		
O-I	0 / 8405	-18.5	-18.5 0.58 (1)		
I-P	0 / 8490	-18.5	-18.5 0.57 (1)		
P-H	0 / 8490	-18.5	-18.5 0.57 (1)		
H-Q	0 / 8490	-18.5	-18.5 0.57 (1)		
Q-G	0 / 8490	-18.5	-18.5 0.57 (1)		
G-R	0 / 0	-18.5	-18.5 0.38 (1)		
R-S	0 / 0	-18.5	-18.5 0.38 (1)		
S-F	0 / 0	-18.5	-18.5 0.38 (1)		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC	LC1	MAX	FACE	DIR	TYPE	HEEL	CONN.
I	9-5-4	-1807	-1807	---	BACK	VERT	TOTAL	C1
L	1-5-4	-1881	-1881	---	BACK	VERT	TOTAL	C1
M	3-5-4	-1881	-1881	---	BACK	VERT	TOTAL	C1
N	5-5-4	-1881	-1881	---	BACK	VERT	TOTAL	C1
O	7-5-4	-1807	-1807	---	BACK	VERT	TOTAL	C1
P	11-5-4	-1807	-1807	---	BACK	VERT	TOTAL	C1
Q	13-5-4	-1807	-1807	---	BACK	VERT	TOTAL	C1
R	15-5-4	-1807	-1807	---	BACK	VERT	TOTAL	C1
S	17-5-12	-1807	-1807	---	BACK	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 103 = 205 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(58 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.83")
CALCULATED VERT. DEFL. (LL) = L/999 (0.12")
ALLOWABLE DEFL. (TL) = L/360 (0.83")
CALCULATED VERT. DEFL. (TL) = L/999 (0.21")

CSI: TC=0.72/1.00 (D-E:1), BC=0.57/1.00 (G-I:1), WB=0.77/1.00 (E-G:1), SS=0.81/1.00 (G-I:1)

DOL LUMBER-1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (A) (INPUT = 0.80)
JSI METAL= 0.91 (H) (INPUT = 1.00)



Structural component only
DWG# T-2007896 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRAWG NO.
408312	T15	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 12:08:42 2020 Page 2
ID:DMCubINVR6Ts[Foe31v6I zns11-vv19/KwAnhst56TAbdQnAhc UAXg1DWXTaoFw0zLYNt

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWW-t	MT20	6.0	9.0	2.25	3.75
B	TMWW-t	MT20	4.0	6.0	3.00	1.00
C	TTW-p	MT20	6.0	9.0	Edge	
D	TMWW-t	MT20	4.0	6.0	3.00	1.00
E	TMWW-t	MT20	6.0	9.0	2.25	3.75
F	BMV1-t	MT20	5.0	8.0	Edge	2.25
G	BMWW-t	MT20	6.0	9.0	4.25	4.50
H	BS-t	MT20	6.0	8.0		
I	BMWW-t	MT20	8.0	9.0		
J	BMWW-t	MT20	8.0	8.0	4.25	4.50
K	BMV1-t	MT20	6.0	8.0	5.50	


Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2007896 3/2

JOB NAME 408312	TRUSS NAME T16	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Wed Apr 29 16:28:24 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-Rlx19C1WwX7_ObW?auhzcyQ00Y_Gbekvl_tLWzLpgD

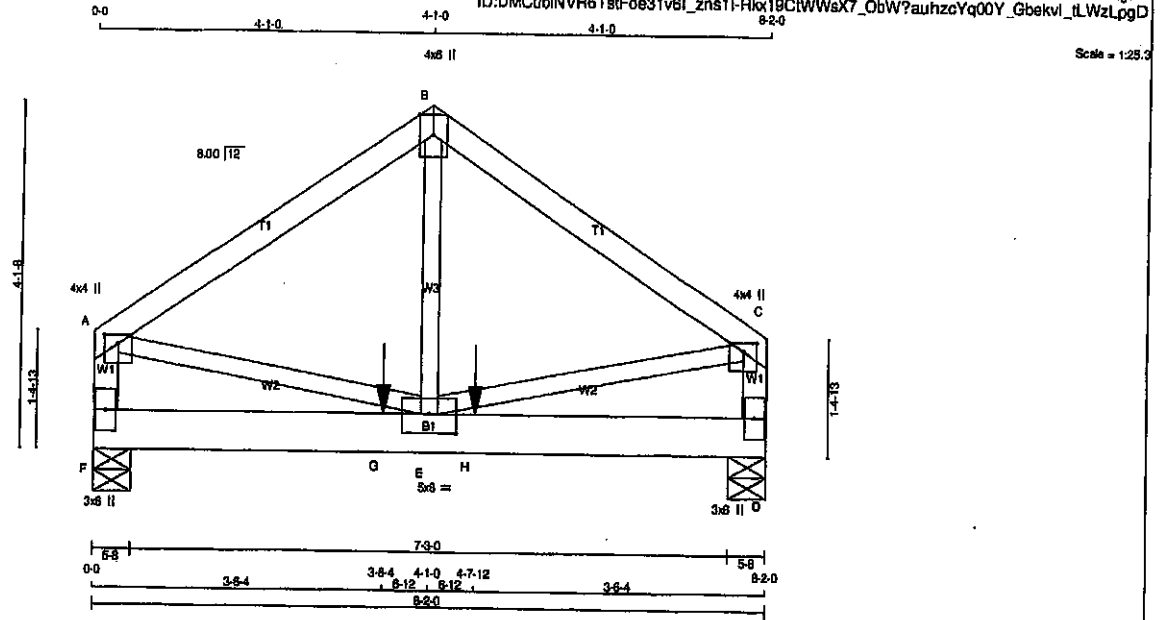

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF		
B - C	2x4	DRY	No.2	SPF		
F - A	2x4	DRY	No.2	SPF		
D - C	2x4	DRY	No.2	SPF		
F - D	2x6	DRY	No.2	SPF		
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF		

DRY: SEASONED LUMBER.
DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-B 1	12	TOP
B-C 1	12	TOP
F-A 1	12	TOP
D-C 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F-D 2	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.
TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.
SIDE - PLF SHOWN IS THE EQUIVALENT UOL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TM/VW+p	MT20	4.0	4.0	1.25	2.00
B	TTW+p	MT20	4.0	6.0	Edge	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	RECORD
JT VERT	DOWN	BRG	BRG
F 1847	0	5-8	5-8
D 1647	0	5-8	5-8

UNFACTORED REACTIONS	1ST LCASE	MAX/MIN. COMPONENT REACTIONS
JT COMBINED	SNOW	LIVE
F 1159	790/0	0/0
D 1159	791/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, D

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH	WEBS	MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)
A-B	-1798/0	-91.8	-91.8	0.16 (1)	6.25	E-B	0/1620	0.20 (1)		
B-C	-1798/0	-91.8	-91.8	0.16 (1)	6.25	A-E	0/1540	0.19 (1)		
F-A	-1550/0	0.0	0.0	0.09 (1)	7.81	E-C	0/1540	0.19 (1)		
D-C	-1550/0	0.0	0.0	0.09 (1)	7.81					
F-B	0/0	-18.5	-18.5	0.16 (1)	10.00					
G-E	0/0	-18.5	-18.5	0.16 (1)	10.00					
E-H	0/0	-18.5	-18.5	0.16 (1)	10.00					
H-D	0/0	-18.5	-18.5	0.16 (1)	10.00					

FACTORED CONCENTRATED LOADS (LBS)	JT LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
G	3-8-4	-1196	-1196	---	BACK	VERT	TOTAL	C1
H	4-7-12	-1196	-1196	---	BACK	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 37 = 74 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.27")
CALCULATED VERT. DEFL.(LL) = L/889 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.27")
CALCULATED VERT. DEFL.(TL) = L/889 (0.02")

CS1: TC=0.16/1.00 (B-C:1), BC=0.16/1.00 (D-E:1), WB=0.20/1.00 (E-E:1), SS=0.39/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (A) (INPUT = 0.90)
JSI METAL= 0.22 (A) (INPUT = 1.00)



Structural component only
DWG# T-2007897 1/2

JOB NAME 408312	TRUSS NAME T16	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					


Temerack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Wed Apr 29 16:26:24 2020 Page 2
ID:DMCubINVR6TslFoe31v6l zns1l-Rkx19CiWWsX7 QbW7auhzcYq00Y Gbekvl iLWzLqD

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
C	TMVW+p	MT20	4.0	4.0	1.25	2.00
D	BMV1+p	MT20	3.0	6.0		
E	BMVWW-I	MT20	5.0	8.0	2.75	4.00
F	BMV1+p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

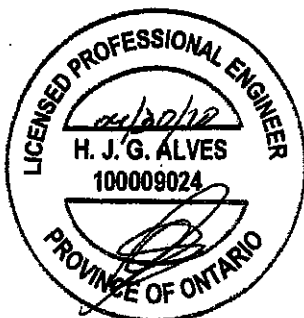

Structural component only
DWG# T-2007897 3/2

JOB NAME 408312	TRUSS NAME G17	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 6.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 29 16:25:57 2020 Page 1
ID:DMCubINVR6TstFoe31v61_zns11-YopUzYbtZ8yFE1KvPvMNwvES7MrRQUmh2xtazLpgg

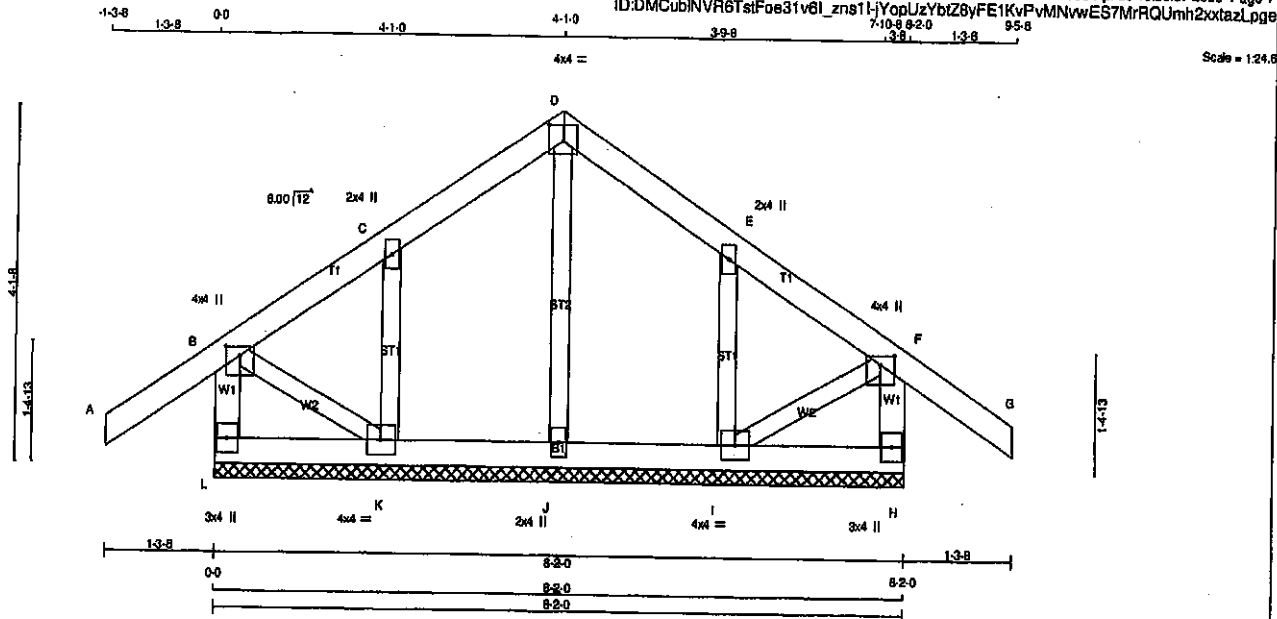

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR
L - B	2x4	DRY	No.2
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2

ALL GABLE WEBS 2x3 DRY No.2

DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TMVW+w	MT20	2.0	4.0		
D	TTW+p	MT20	4.0	4.0	2.25	2.00
E	TMVW+w	MT20	2.0	4.0		
F	TMVW+p	MT20	4.0	4.0	1.25	2.00
H	BMV1+p	MT20	3.0	4.0		
I	BMVW1-t	MT20	4.0	4.0		
J	BMV1+w	MT20	2.0	4.0		
K	BMVW1-t	MT20	4.0	4.0		
L	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LCI (L/C)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LCI (L/C)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO			
L-B	-216 / 0	0.0	0.0	0.02 (1)	J-D	-133 / 0	0.03 (1)
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	K-C	-228 / 0
B-C	-9 / 0	-91.8	-91.8	0.08 (1)	10.00	I-E	-228 / 0
C-D	-25 / 0	-91.8	-91.8	0.08 (1)	6.25	B-K	0 / 20
D-E	-25 / 0	-91.8	-91.8	0.08 (1)	6.25	I-F	0 / 20
E-F	-9 / 0	-91.8	-91.8	0.08 (1)	10.00		
F-G	0 / 35	-91.8	-91.8	0.12 (1)	10.00		
H-F	-216 / 0	0.0	0.0	0.02 (1)	7.81		
L-K	0 / 0	-18.5	-18.5	0.02 (4)	10.00		
K-J	0 / 10	-18.5	-18.5	0.02 (4)	10.00		
J-I	0 / 10	-18.5	-18.5	0.02 (4)	10.00		
I-H	0 / 0	-18.5	-18.5	0.02 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-06, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (I-J:4), WS=0.04/1.00 (E-I:1), SS=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PL)
MT20	618	354	1567


MAX MIN MAX MIN MAX MIN

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.18 (C) (INPUT = 0.90)

JSI METAL = 0.12 (C) (INPUT = 1.00)

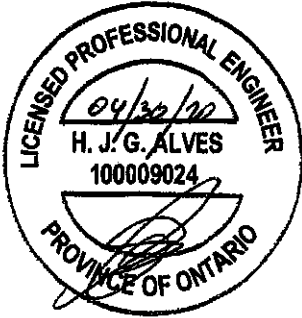

Structural component only
DWG# T-2007878

JOB NAME 408312	TRUSS NAME T18	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

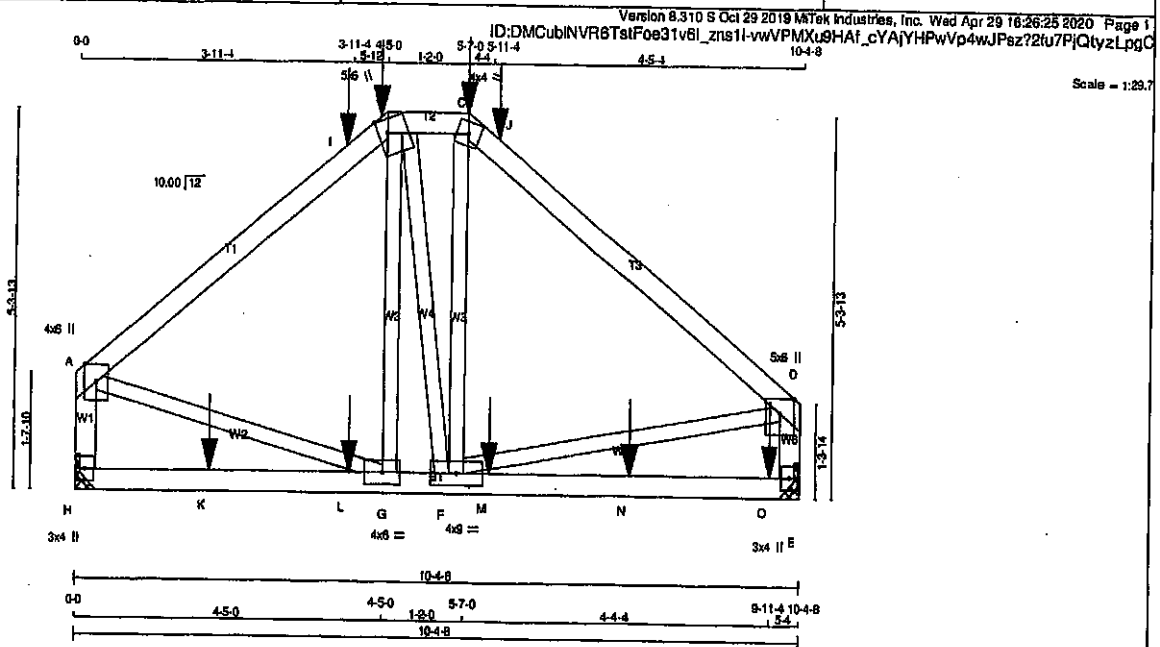

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
H - A	2x4	DRY	No.2
E - D	2x4	DRY	No.2
H - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)			
JT	TYPE	PLATES	W LEN Y X
A	TMVW+p	MT20	4.0 8.0 Edge
B	TTWW+m	MT20	5.0 6.0 2.25 1.50
C	TTW-m	MT20	4.0 4.0
D	TMVW+p	MT20	5.0 8.0 Edge
E	BMVW+p	MT20	3.0 4.0
F	BMWWW-l	MT20	4.0 9.0
G	BMWW-l	MT20	4.0 8.0
H	BMVW+p	MT20	3.0 4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN
H	1215	0	1215
E	1202	0	1202

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H, E. MINIMUM BEARING LENGTH AT JOINT H = 3-8, JOINT E = 3-8.

UNFACTORED REACTIONS			
1ST CASE	MAX/MIN	COMPONENT REACTIONS	
JT	SNOW	LIVE	PERM. LIVE
H	856	582/0	0/0
E	850	557/0	0/0

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.38 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO			
A-I	-1038/0	-91.8	-91.8
I-B	-1038/0	-91.8	-91.8
B-C	-842/0	-91.8	-91.8
C-J	-1047/0	-91.8	-91.8
J-D	-1047/0	-91.8	-91.8
H-A	-1183/0	0.0	0.0
E-D	-1112/0	0.0	0.0
H-K	0/0	-18.5	-18.5
K-L	0/0	-18.5	-18.5
L-G	0/0	-18.5	-18.5
G-F	0/830	-18.5	-18.5
F-M	0/0	-18.5	-18.5
M-N	0/0	-18.5	-18.5
N-O	0/0	-18.5	-18.5
O-E	0/0	-18.5	-18.5

FACTORED CONCENTRATED LOADS (LBS)			
JT	LOC.	LOC1	MAX. MAX.
B	4-5-0	-85	-82
B	4-5-0	-285	-285
C	5-7-0	-55	-82
C	5-7-0	-285	-285
I	3-11-4	-202	-202
J	5-11-4	-207	-207
K	1-11-4	-38	-38
L	3-11-4	-38	-38
M	5-11-4	-38	-38
N	7-11-4	-38	-38
O	9-11-4	-41	-41

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.35")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.35")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CS: TC=0.51/1.00 (C-D:1), BC=0.30/1.00 (F-G:4), WB=0.21/1.00 (A-G:1), SS=0.27/1.00 (C-D:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PS) (PLI) (FLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1667 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.86 (A) (INPUT = 0.80)
JSI METAL=0.51 (A) (INPUT = 1.00)



Structural component only
DWG# T-2007898

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408312	T19S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Wed Apr 29 16:26:26 2020 Page 1					
ID:DMCubINVR8TstFoe31v61_zns11-N73natvn2TrrDh1v67x920d8tp4rkTB1M3TzPPzLpgB					
Scale = 1:27.8					

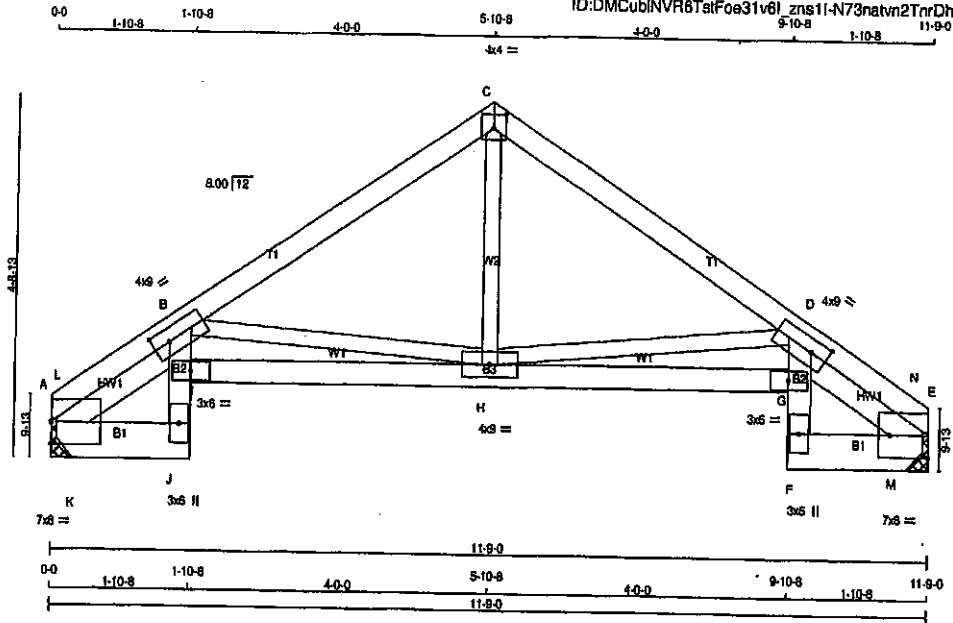

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
A - J	2x6	DRY	No.2
J - B	2x4	DRY	No.2
I - G	2x4	DRY	No.2
F - D	2x4	DRY	No.2
F - E	2x6	DRY	No.2
REINFORCING MEMBERS			
HW1	2x4	DRY	No.2
HW2	2x4	DRY	No.2
ALL WEBS 2x3 DRY SEASONED LUMBER.			
			No.2

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMBMW-1	MT20	7.0	8.0
B	TMBVW-1	MT20	4.0	9.0 2.00 2.75
C	TTW-p	MT20	4.0	4.0 2.25 2.00
D	TMBVW-1	MT20	4.0	9.0 2.00 2.75
E	TMBMW-1	MT20	7.0	8.0 3.50 Edge
F	BMV-p	MT20	3.0	8.0
G	BMV-p	MT20	3.0	8.0
H	BMVW-1	MT20	4.0	9.0
I	BMV-p	MT20	3.0	8.0
J	BMV-p	MT20	3.0	8.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
A	848	0	848	0	0
E	848	0	848	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT A, E. MINIMUM BEARING LENGTH AT JOINT A = 3'-8", JOINT E = 3'-8".

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM	LIVE	WIND	DEAD	SOIL
A	458	301 / 0	0 / 0	0 / 0	0 / 0	0 / 0	157 / 0	0 / 0
E	458	301 / 0	0 / 0	0 / 0	0 / 0	0 / 0	157 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED	MAX. FACTORED
MEMB.	FORCE	VERT.	LOAD	LC1	MEMB.	FORCE	MAX
FR-TO	(LBS)	FROM	TO	CSI (LC)	FR-TO	(LBS)	CSI (LC)
A-L	-708 / 0	-91.8	-91.8	0.02 (1)	H-C	0 / 389	0.09 (1)
L-S	-442 / 0	-91.8	-91.8	0.04 (4)	H-D	-873 / 0	0.26 (1)
S-C	-685 / 0	-91.8	-91.8	0.27 (1)	B-H	-873 / 0	0.26 (1)
C-D	-685 / 0	-91.8	-91.8	0.27 (1)	K-L	0 / 276	0.00 (1)
D-N	-442 / 0	-91.8	-91.8	0.04 (4)	K-B	-382 / 0	0.05 (1)
N-E	-708 / 0	-91.8	-91.8	0.02 (1)	M-N	0 / 276	0.00 (1)
					M-D	-382 / 0	0.05 (1)
A-K	0 / 387	-18.5	-18.5	0.05 (1)			
K-J	0 / 619	-18.5	-18.5	0.09 (1)			
J-I	0 / 18	0.0	0.0	0.77 (1)			
I-B	-33 / 25	0.0	0.0	0.77 (1)			
H-G	0 / 1429	-18.5	-18.5	0.26 (1)			
G-F	0 / 1429	-18.5	-18.5	0.26 (1)			
F-G	0 / 18	0.0	0.0	0.77 (1)			
G-D	-33 / 25	0.0	0.0	0.77 (1)			
F-M	0 / 619	-18.5	-18.5	0.06 (1)			
M-E	0 / 387	-18.5	-18.5	0.05 (1)			

TOTAL WEIGHT = 2 X 49 = 97 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.8 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 38.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBCG 2010, CBC 2012, ABC 2019
- PART 9 OF CBCG 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.39")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.39")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TC=0.27/1.00 (C-D:1), SC=0.77/1.00 (F-G:1),
WB=0.26/1.00 (D-H:1), SB=0.63/1.00 (B-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.85 (C) (INPUT = 0.80)
JSI METAL= 0.40 (I) (INPUT = 1.00)



Structural component only
DWG# T-2007899

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408312	T20	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Wed Apr 29 16:26:28 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns11-JVAX7Zw1a5Z2T7vIECzd7RiXIduuCOjKqNy4UHzi.pg9

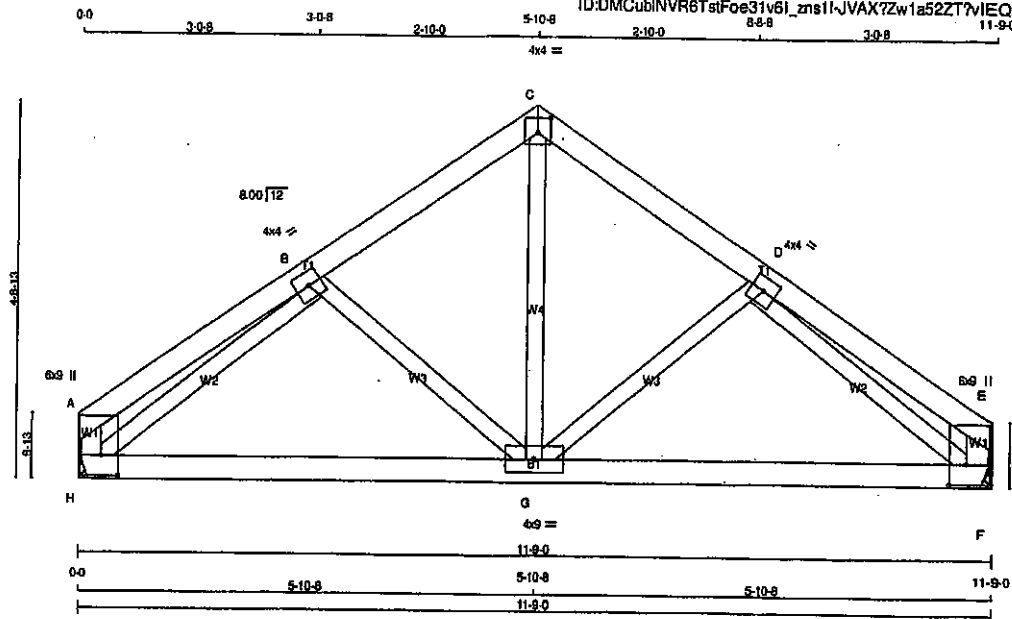

Scale = 1:25.7

LUMBER	N. L. & A. RULES	SIZE	DRY	LUMBER
CHORDS				
A - C	2x4	DRY	No.2	
C - E	2x4	DRY	No.2	
H - A	2x4	DRY	No.2	
F - E	2x4	DRY	No.2	
H - F	2x4	DRY	No.2	

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

DESCR.
SPF
SPF
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
H	848	0	848	0
F	848	0	848	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H, F. MINIMUM BEARING LENGTH AT JOINT H = 1-8, JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	458	301/0	0/0	0/0	0/0	157/0	0/0
F	458	301/0	0/0	0/0	0/0	157/0	0/0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO						FR-TO			
A-B	0/16	-91.8	-91.8	0.12 (1)	10.00	G-C	0/382	0.09 (1)	10.00
B-C	-553/0	-91.8	-91.8	0.09 (1)	6.25	G-D	-195/0	0.05 (1)	10.00
C-D	-553/0	-91.8	-91.8	0.09 (1)	6.25	B-G	-195/0	0.05 (1)	10.00
D-E	0/16	-91.8	-91.8	0.12 (1)	10.00	H-B	-778/0	0.19 (1)	10.00
H-A	-108/0	0.0	0.0	0.01 (1)	7.81	D-F	-778/0	0.19 (1)	10.00
F-E	-108/0	0.0	0.0	0.01 (1)	7.81				
H-G	0/597	-18.5	-18.5	0.23 (4)	10.00				
G-F	0/597	-18.5	-18.5	0.23 (4)	10.00				

TOTAL WEIGHT = 48 lb

(M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOY CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. G.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.39")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01")
ALLOWABLE DEFL. (TL) = $L/360$ (0.39")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.04")

CSI: TC=0.12/1.00 (D-E:1), BC=0.23/1.00 (G-H:4), WB=0.19/1.00 (D-F:1), SB=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.90 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 758

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.64 (C) (INPUT = 0.90)
JSI METAL = 0.27 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007900

JOB NAME 408312	TRUSS NAME T21	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

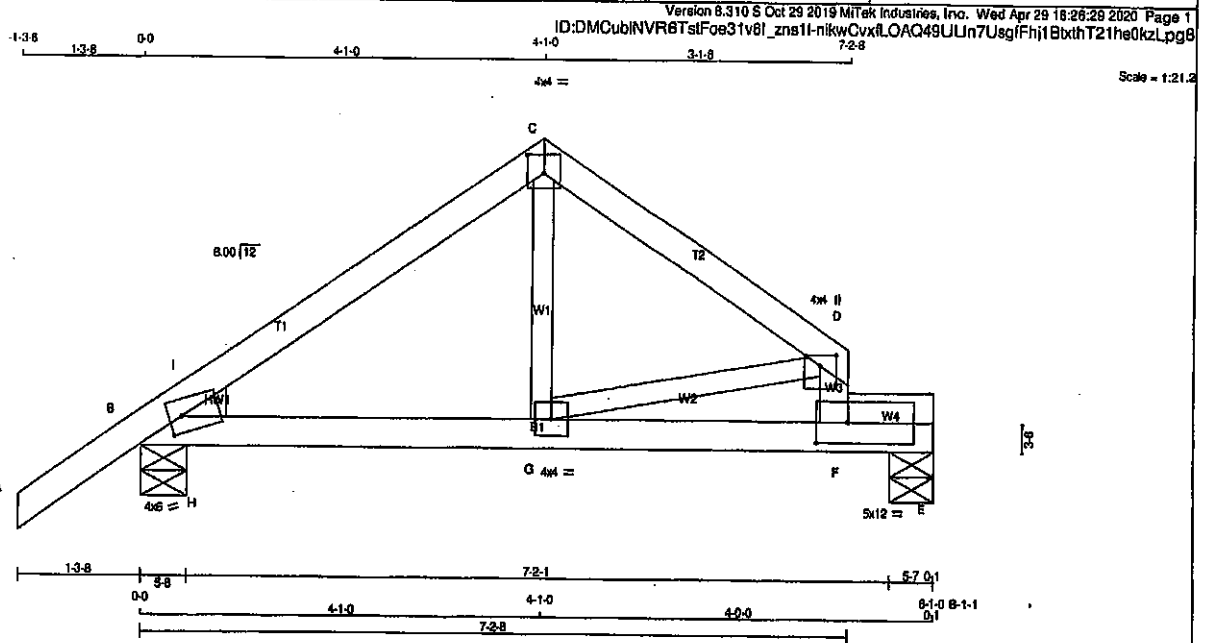

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS			
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMBH1-m	MT20	4.0	6.0	2.00 1.50
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TMVW-p	MT20	4.0	4.0	1.25 2.00
F	BMVW-t	MT20	5.0	12.0	2.50 4.00
G	BMVW-t	MT20	4.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	GROSS REACTION	BRG	BRG	IN-SX	IN-SX	HEEL
B	568	0	568	0	5-8	5-8	2x4 L
E	369	0	369	0	5-8 (5-7)	5-8	

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS					
B	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	369	275 / 0	0 / 0	0 / 0	0 / 0	124 / 0	0 / 0
	263	164 / 0	0 / 0	0 / 0	0 / 0	98 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 (LC)	UNBRACED LENGTH (FT)
FR-TO		FROM TO		FR-TO			
A-B	0 / 34	-91.6 -91.6	0.12 (1)	10.00	G-C	0 / 188	0.04 (1)
B-I	-421 / 0	-91.6 -91.6	0.05 (1)	8.25	G-D	0 / 375	0.08 (1)
I-C	-447 / 0	-91.6 -91.6	0.17 (1)	8.25	H-J	-231 / 0	0.00 (1)
C-D	-441 / 0	-91.6 -91.6	0.16 (1)	8.25			
F-D	-469 / 0	0.0 0.0	0.05 (1)	7.81			
B-H	0 / 387	-18.5 -18.5	0.23 (1)	10.00			
H-G	0 / 387	-18.5 -18.5	0.24 (1)	10.00			
G-F	0 / 0	-18.5 -18.5	0.43 (1)	10.00			
F-E	0 / 0	-18.5 -18.5	0.18 (1)	10.00			

TOTAL WEIGHT = 3 X 28 = 84 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.27")
CALCULATED VERT. DEFL.(LL) = $1/999$ (0.04")
ALLOWABLE DEFL.(TL) = $L/360$ (0.27")
CALCULATED VERT. DEFL.(TL) = $1/999$ (0.08")

CS: TC=0.17/1.00 (C-1:1), BC=0.43/1.00 (F-G:1),
WB=0.08/1.00 (D-G:1), SB=0.16/1.00 (B-H:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1687 788
	1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.43 (D) (INPUT = 0.90)
JSI METAL= 0.17 (F) (INPUT = 1.00)



Structural component only
DWG# T-2007901

JOB NAME 408312	TRUSS NAME G22	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MITK Industries, Inc. Wed Apr 29 16:25:59 2020 Page 1 ID:DMCubINVR6TstFos31v6l_zns1l-gwwavearPAOgUYB11ayqSK7ayx2BvK639MQ2yTzLppc			

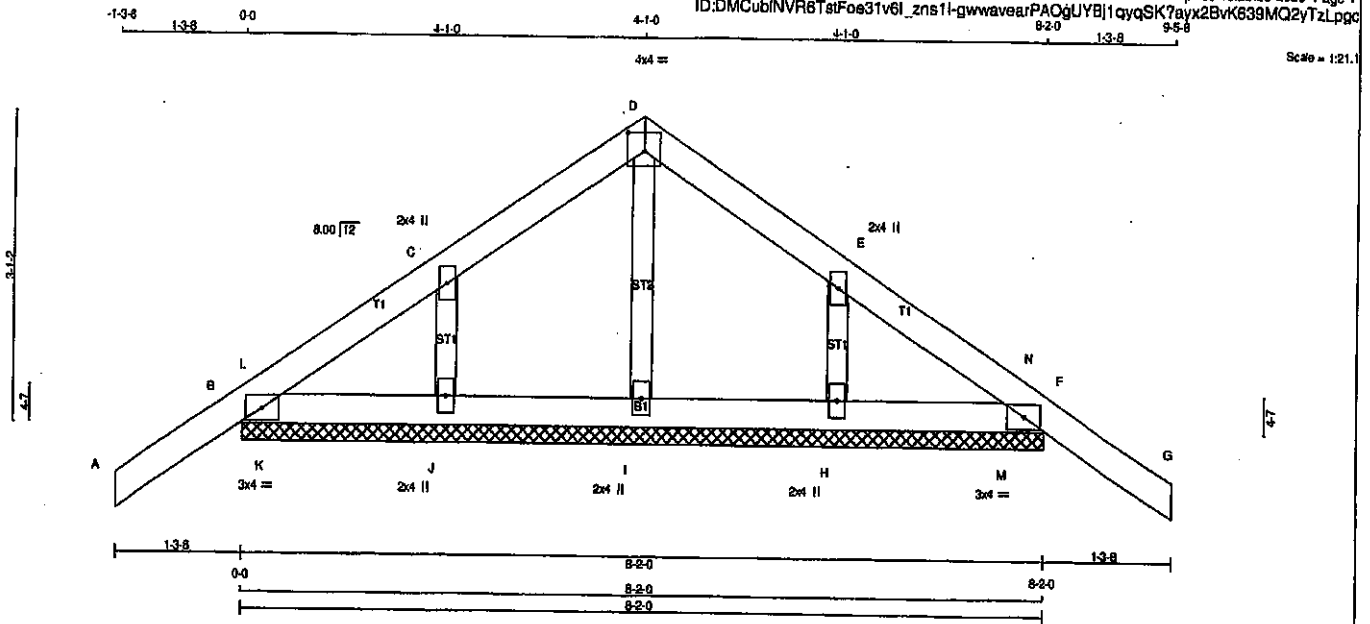

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
B - F	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

ALL GABLE WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0		
C	TW-w	MT20	2.0	4.0		
D	TTW-p	MT20	4.0	4.0	2.25	2.00
E	TW-w	MT20	2.0	4.0		
F	TMB1-I	MT20	3.0	4.0		
H, I, J	BMW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	MAX. FACTORED CSI (LC)
FR-TO		FROM TO		FR-TO			
A-B	0/34	-91.8 -91.8 0.12 (1)	10.00	I-D	-115/0		0.02 (1)
B-L	-56/0	-91.8 -91.8 0.01 (4)	8.25	J-C	-213/0		0.03 (1)
L-C	-32/0	-91.8 -91.8 0.06 (1)	8.25	H-E	-213/0		0.03 (1)
C-O	-43/0	-91.8 -91.8 0.06 (1)	8.25	K-L	-49/4		0.00 (1)
D-E	-43/0	-91.8 -91.8 0.06 (1)	8.25	M-N	-49/4		0.00 (1)
E-N	-32/0	-91.8 -91.8 0.06 (1)	8.25				
N-F	-56/0	-91.8 -91.8 0.01 (4)	8.25				
F-G	0/34	-91.8 -91.8 0.12 (1)	10.00				
B-K	0/39	-18.5 -18.5 0.03 (1)	10.00				
K-J	0/39	-18.5 -18.5 0.03 (1)	10.00				
J-I	0/26	-18.5 -18.5 0.02 (1)	10.00				
I-H	0/26	-18.5 -18.5 0.02 (1)	10.00				
H-M	0/39	-18.5 -18.5 0.03 (1)	10.00				
M-F	0/39	-18.5 -18.5 0.03 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (F-G:1), BC=0.03/1.00 (J-K:1), WS=0.03/1.00 (C-J:1), SS=0.08/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
		768	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (F) (INPUT = 0.90)

JSI METAL= 0.11 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007879

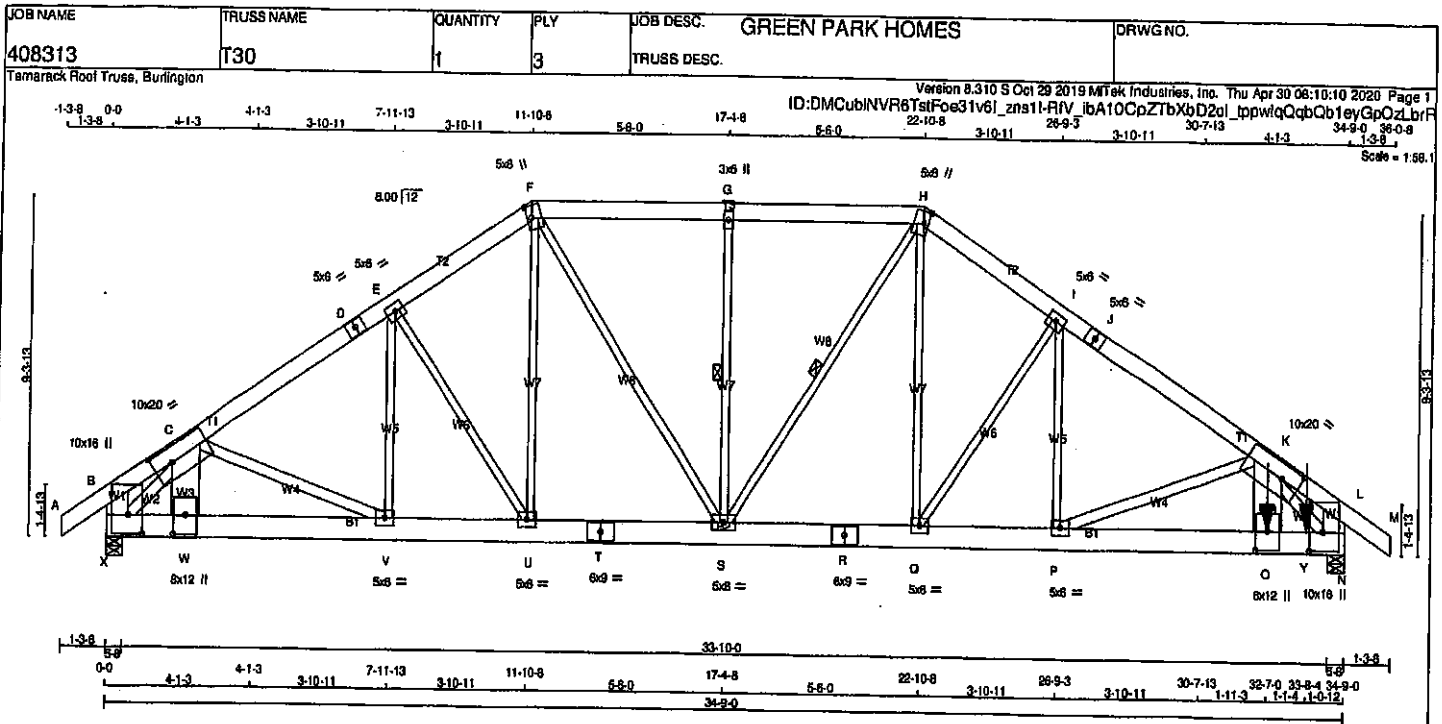

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x8	DRY	No.2	SPF		
D - F	2x8	DRY	No.2	SPF		
F - H	2x8	DRY	No.2	SPF		
H - J	2x8	DRY	No.2	SPF		
J - M	2x8	DRY	No.2	SPF		
X - B	2x8	DRY	No.2	SPF		
N - L	2x8	DRY	No.2	SPF		
X - T	2x8	DRY	No.2	SPF		
T - R	2x8	DRY	No.2	SPF		
R - N	2x8	DRY	No.2	SPF		
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF		
W - C	2x10	DRY	No.2	SPF		
C - V	2x4	DRY	No.2	SPF		
P - K	2x4	DRY	No.2	SPF		
O - K	2x10	DRY	No.2	SPF		
X - C	2x4	DRY	No.2	SPF		
K - N	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 3 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-D 2	12	TOP
D-F 2	12	TOP
F-H 2	12	TOP
H-J 2	12	TOP
J-M 2	12	TOP
X-B 2	12	TOP
N-L 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
X-T 4	4	TOP
T-R 2	12	TOP
R-N 4	4	SIDE(2105.9)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	8	SIDE(873.2)
2x4 1	8	
K-O 5	4	
2x10 5	4	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
X	2702	0	2702	0
N	12441	0	12441	0

UNFACTORED REACTIONS	1ST LOASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED	SNOW
X	1907	1270 / 0
N	8784	5843 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) X, N

BRACING
TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 5.65 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-S, H-S.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 (PLF)	MEMB.	FORCE (LBS)
FR-TO			FR-TO	
A-B	0 / 36	-91.8 -91.8 0.02 (1)	W-C	-21 / 68
B-C	0 / 35	-91.8 -91.8 0.03 (1)	C-V	0 / 520
C-D	-3361 / 0	-91.8 -91.8 0.06 (1)	V-E	-84 / 45
D-E	-3361 / 0	-91.8 -91.8 0.06 (1)	E-U	-374 / 0
E-F	-3164 / 0	-91.8 -91.8 0.05 (1)	U-F	0 / 412
F-G	-3232 / 0	-91.8 -91.8 0.07 (1)	F-S	0 / 1182
G-H	-3232 / 0	-91.8 -91.8 0.07 (1)	S-G	-583 / 0
H-I	-4137 / 0	-91.8 -91.8 0.09 (1)	S-H	-352 / 0
I-J	-5777 / 0	-91.8 -91.8 0.15 (1)	Q-H	0 / 2276
J-K	-5777 / 0	-91.8 -91.8 0.15 (1)	Q-I	-2708 / 0
K-L	-114 / 0	-91.8 -91.8 0.10 (1)	P-I	0 / 2567
L-M	0 / 36	-91.8 -91.8 0.02 (1)	P-K	-5904 / 0
X-B	-164 / 0	0.0 0.0 0.00 (1)	O-K	0 / 9561
N-L	-432 / 0	0.0 0.0 0.01 (1)	X-C	-3371 / 0
			K-N	-14782 / 0
X-W	0 / 2318	-18.5 -18.5 0.10 (1)		
W-V	0 / 2318	-18.5 -18.5 0.10 (1)		
V-U	0 / 2803	-18.5 -18.5 0.10 (1)		
U-T	0 / 2604	-18.5 -18.5 0.10 (1)		
T-S	0 / 2604	-18.5 -18.5 0.10 (1)		
S-R	0 / 3419	-18.5 -18.5 0.12 (1)		
R-Q	0 / 3419	-18.5 -18.5 0.12 (1)		
Q-P	0 / 4888	-18.5 -18.5 0.19 (1)		
P-O	0 / 10385	-18.5 -18.5 0.57 (1)		
O-Y	0 / 10163	-18.5 -18.5 0.56 (1)		
Y-N	0 / 10163	-18.5 -18.5 0.56 (1)		

FACTORED CONCENTRATED LOADS (LBS)	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
JT									
O	32-7-0	-10008	-10008		BACK	VERT	TOTAL		C1
Y	33-8-4	-1043	-1043		BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 N. GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (1.16")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TO=0.15/1.00 (H-K:1), BC=0.57/1.00 (O-P:1),
WB=0.68/1.00 (K-P:1), SSI=0.23/1.00 (N-O:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1807 788 1987 1686

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.83 (P) (INPUT = 0.90)
JSI METAL= 0.77 (O) (INPUT = 1.00)

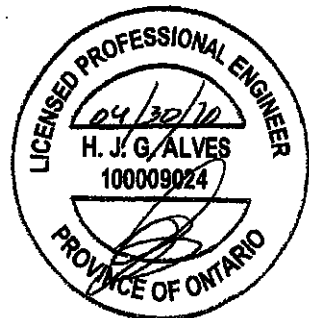

Structural component only
DWG# T-2007918 1/2

JOB NAME 408313	TRUSS NAME T30	QUANTITY 1	PLY 3	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 6.310 5 Oct 29 2019 Mtek Industries, Inc. Thu Apr 30 08:10:10 2020 Page 2
ID:DMCubINVR8TsIFoe31v6L zns1L-RIV ibA10CpZTbXbD2ej ppwlgQabQb1evGpOzLbrF

STAGGER NAILS BY HALF THE SURFACE SPACING IN ADJACENT PLIES.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B, L, N, X						
B	TMBMWV1*	pMT20	10.0	18.0	6.25	4.50
C	TMWWV1	MT20	10.0	20.0	4.75	6.25
D	TS-1	MT20	5.0	6.0		
E	TMWW-1	MT20	5.0	6.0		
F	TTWW+m	MT20	5.0	8.0	4.00	1.50
G	TMW+w	MT20	3.0	6.0		
H	TTWW+m	MT20	5.0	8.0	4.00	1.50
I	TMWW-1	MT20	5.0	6.0		
J	TS-1	MT20	5.0	6.0		
K	TMWWV1	MT20	10.0	20.0	4.75	6.25
N	TMBMWV1*	pMT20	10.0	18.0	6.25	4.50
O	BMW+w	MT20	8.0	12.0	6.25	4.00
P, Q, U, V						
P	BMWW-1	MT20	5.0	6.0		
R	BS-1	MT20	6.0	9.0		
S	BMWWV1	MT20	5.0	8.0		
T	BS-1	MT20	6.0	9.0		
W	BMW+w	MT20	8.0	12.0	6.25	4.00




Structural component only
DWG# T-2007918 22

DRWG NO.

DRWG NO.

Structural component only
DWG# T-2007919

JOB NAME 408313	TRUSS NAME T32	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 28 2019 Mtek Industries, Inc. Thu Apr 30 08:10:12 2020 Page 1	
1-3-8 0-0 4-11-0 4-11-0 4-8-8 9-7-8 6-3-8 15-11-0 6-3-8 22-2-8 5-8-0 27-8-8 28-8-8 4-1-8 32-10-0 1-3-8 1-3-8 0-0 4-11-0 4-11-0 4-8-8 9-7-8 6-3-8 15-11-0 6-3-8 22-2-8 5-8-0 27-8-8 28-8-8 4-1-8 32-10-0 1-3-8				ID:DMCub\NVR6TatFos31v6I_zns11-01d7H8Hyp3HuhzK7TA3IV3J5YLIW_luyRINIGzLbrP 32-10-0 32-1-8 Scale = 1:54.7	

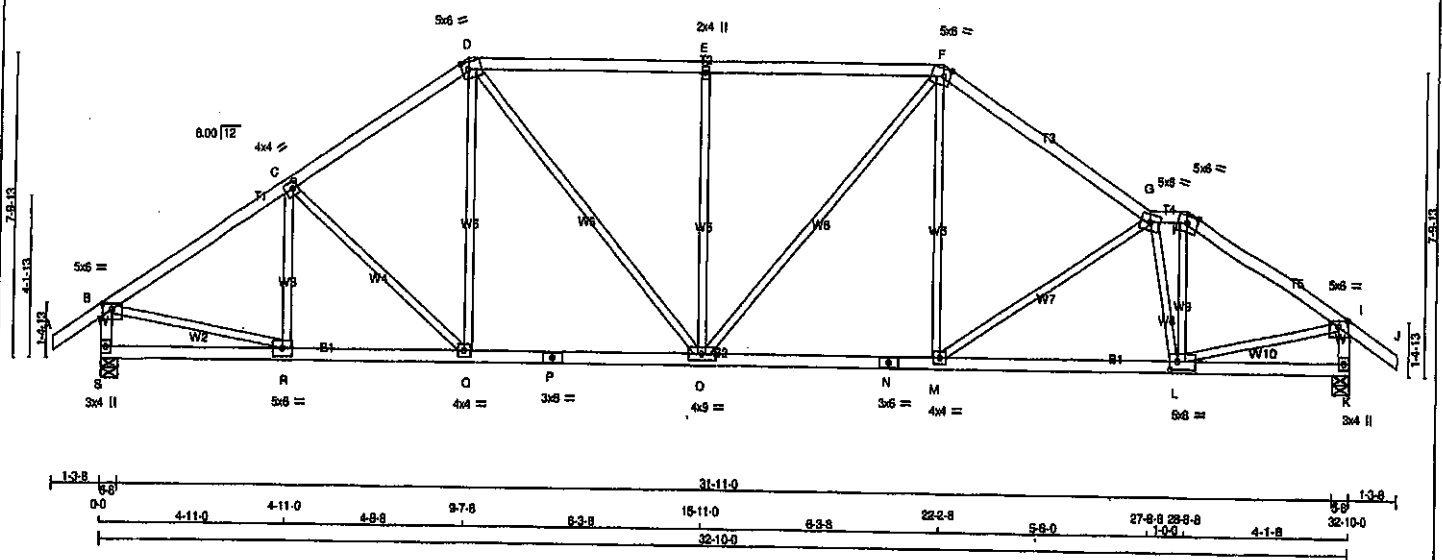

LUMBER			
N.L.G.A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
S - P	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY, SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMVW-p	MT20	5.0	8.0	1.75 3.00
C TMVW-t	MT20	4.0	4.0	2.00 1.50
D TTVW-m	MT20	5.0	8.0	2.25 2.00
E TMVW-w	MT20	2.0	4.0	
F TTVW-m	MT20	5.0	8.0	2.25 2.00
G TTVW-m	MT20	5.0	8.0	
H TTVW-m	MT20	5.0	8.0	Edge
I TMVW-p	MT20	5.0	8.0	1.75 3.00
K BMV1-p	MT20	3.0	4.0	
L BMVWW-t	MT20	5.0	8.0	2.50 2.50
M BMVWW-t	MT20	4.0	4.0	
N BS-t	MT20	3.0	6.0	
O BMVWW-t	MT20	4.0	9.0	
P BS-t	MT20	3.0	6.0	
Q BMVWW-t	MT20	4.0	4.0	
R BMVWW-t	MT20	5.0	8.0	
S BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	DOWN	HORIZ	BRG	IN-SX	BRG	IN-SX
S	1936	0	1936	0	5-8	5-8	5-8
K	1936	0	1936	0	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX/MIN COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
S	1367	910/0	0/0	0/0	0/0
K	1367	910/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.14 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.
FR-TO				FR-TO			
A-B	0/35	-91.8	-91.8 0.12 (1)	10.00	R-C	-306/0	0.10 (1)
B-C	-2134/0	-91.8	-91.8 0.34 (1)	4.35	C-O	-209/0	0.18 (1)
C-D	-2007/0	-91.8	-91.8 0.32 (1)	4.47	O-D	0/248	0.08 (1)
D-E	-2037/0	-91.8	-91.8 0.54 (1)	4.14	D-O	0/608	0.14 (1)
E-F	-2037/0	-91.8	-91.8 0.54 (1)	4.14	O-E	-707/0	0.81 (1)
F-G	-2087/0	-91.8	-91.8 0.44 (1)	4.27	O-F	0/482	0.10 (1)
G-H	-1778/0	-91.8	-91.8 0.04 (1)	5.00	M-F	0/328	0.07 (1)
H-I	-2080/0	-91.8	-91.8 0.28 (1)	4.48	M-G	-362/0	0.32 (1)
I-J	0/35	-91.8	-91.8 0.12 (1)	10.00	L-H	0/924	0.21 (1)
S-B	-1895/0	0.0	0.0 0.20 (1)	6.10	B-R	0/1842	0.41 (1)
K-I	-1904/0	0.0	0.0 0.20 (1)	6.09	L-I	0/1781	0.40 (1)
S-R	0/0	-18.5	-18.5 0.09 (4)	10.00	G-L	-1277/0	0.34 (1)
R-Q	0/1789	-18.5	-18.5 0.38 (1)	10.00			
Q-P	0/1847	-18.5	-18.5 0.33 (1)	10.00			
P-O	0/1847	-18.5	-18.5 0.33 (1)	10.00			
O-N	0/1741	-18.5	-18.5 0.37 (1)	10.00			
N-M	0/1741	-18.5	-18.5 0.37 (1)	10.00			
M-L	0/2035	-18.5	-18.5 0.41 (1)	10.00			
L-K	0/0	-18.5	-18.5 0.11 (4)	10.00			

TOTAL WEIGHT = 145 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL PLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.09")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (1.09")
CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CSI: TC=0.84/1.00 (D-E:1), BC=0.41/1.00 (L-M:1), WB=0.81/1.00 (E-O:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1686

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (I) (INPUT = 0.90)
JSI METAL = 0.56 (G) (INPUT = 1.00)



Structural component only
DWG# T-2007920

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 08:10:14 2020 Page 1
ID:DMCubINVR6TstFoe31tv8t_zns1l-KQKvVYDX4QJ_xCqMSute8j_QGvDymS8AYGwUy9zLbrn
-1-3-8 0-0 5-11-0 5-11-0 5-8-8 11-7-8 15-11-0 20-2-8 4-3-8 4-3-8 5-8-0 25-8-8 25-8-8 1-0-0 2-11-8 29-5-0 32-10-0 34-1-8
1-3-8 5-11-0 5-8-8 11-7-8 15-11-0 20-2-8 4-3-8 4-3-8 5-8-0 25-8-8 25-8-8 1-0-0 2-11-8 29-5-0 32-10-0 34-1-8
Scale = 1:54.7



BEARINGS							
	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQ'D BRG IN-SX	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT		
T	1936	0	1936	0	0	5-8	5-8
L	1936	0	1936	0	0	5-8	5-8

UNFACTORED REACTIONS							
JT	1ST LCASE COMBINED	MAX/MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
T	1367	910 / 0	0 / 0	0 / 0	0 / 0	456 / 0	0 / 0
L	1367	910 / 0	0 / 0	0 / 0	0 / 0	456 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.13 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.
1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-P.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN
THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LO1 (PLF)	MAX. CSI (LC)	MAX. UNBRACED LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	S-C	-215 / 25	0.09 (1)
B-C	-2168 / 0	-91.8	-91.8 0.51 (1)	4.13	Q-Q	-389 / 0	0.46 (1)
C-D	-1835 / 0	-91.8	-91.8 0.47 (1)	4.41	Q-D	0 / 350	0.08 (1)
D-E	-1699 / 0	-91.8	-91.8 0.24 (1)	4.87	D-P	0 / 361	0.08 (1)
E-F	-1699 / 0	-91.8	-91.8 0.24 (1)	4.87	P-E	-473 / 0	0.26 (1)

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

((55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.09")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL)= L/360 (1.09")
CALCULATED VERT. DEFL.(TL) = L/999 (0.17")

CSF: TC=0.51/1.00 (B-C:1), BC=0.40/1.00 (M-C:1),
WB=0.70/1.00 (L-1), SSF=0.22/1.00 (B-C:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMBINATION LIVE LOAD FACTORS 1.20

F-G	-1912 / 0	-91.8	-91.8	0.43 (1)	4.44	P-F	0 / 237	0.05 (1)
G-H	-1776 / 0	-91.8	-91.8	0.04 (1)	5.00	O-F	0 / 437	0.10 (1)
H-I	-2128 / 0	-91.8	-91.8	0.15 (1)	4.55	O-G	-494 / 0	0.58 (1)
I-J	0 / 13	-91.8	-91.8	0.10 (1)	10.00	M-H	0 / 1015	0.23 (1)
J-K	0 / 35	-91.8	-91.8	0.12 (1)	10.00	M-I	0 / 290	0.04 (1)
K-L	-1890 / 0	0.0	0.0	0.19 (1)	6.10	B-S	0 / 1862	0.42 (1)
L-J	-243 / 0	0.0	0.0	0.03 (1)	7.81	I-L	-2305 / 0	0.70 (1)
						G-M	-1039 / 0	0.48 (1)
T-S	0 / 0	-18.5	-18.5	0.15 (4)	10.00			
S-R	0 / 1832	-18.5	-18.5	0.36 (1)	10.00			
R-Q	0 / 1832	-18.5	-18.5	0.36 (1)	10.00			
Q-P	0 / 1542	-18.5	-18.5	0.30 (1)	10.00			
P-O	0 / 1596	-18.5	-18.5	0.32 (1)	10.00			
O-N	0 / 1953	-18.5	-18.5	0.40 (1)	10.00			
N-M	0 / 1953	-18.5	-18.5	0.40 (1)	10.00			
M-L	0 / 1613	-18.5	-18.5	0.35 (1)	10.00			

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRID(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1698

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.



JOB NAME 408313	TRUSS NAME T34	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:10:15 2020 Page 1
ID:DMCubINVR6TslFos31v6l_zns1f-oclmIE9rkRrZMPY?bOthxXb5JZ3VzhKBw1UubzLbrM

Scale = 1:52.3

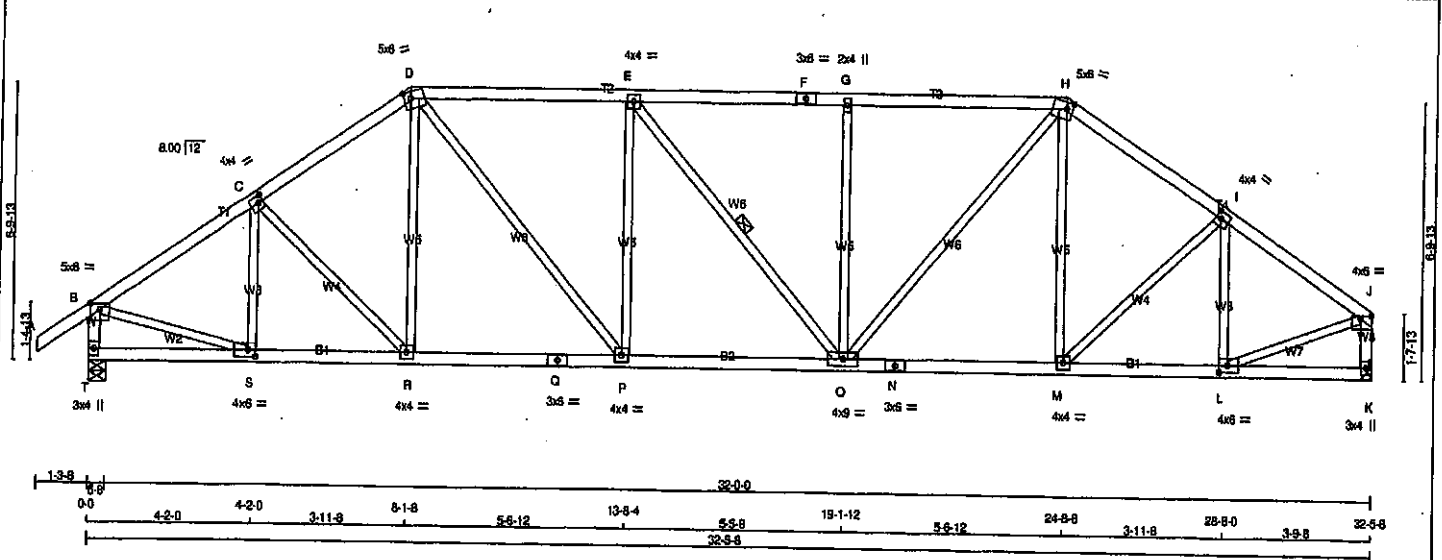

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
T - B	2x4	DRY	No.2
K - J	2x4	DRY	No.2
T - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-p	MT20	5.0	8.0 1.75 3.00
C	TMVW-t	MT20	4.0	4.0 2.00 1.50
D	TTVW-m	MT20	5.0	8.0 2.00 2.00
E	TMVW-t	MT20	4.0	4.0
F	TS-t	MT20	3.0	8.0
G	TMVW-w	MT20	2.0	4.0
H	TTVW-m	MT20	5.0	8.0 2.00 1.75
I	TMVW-t	MT20	4.0	4.0 2.00 1.50
J	TMVW-p	MT20	4.0	8.0 1.00 3.25
K	BMV1-p	MT20	3.0	4.0
L	BMVW-t	MT20	4.0	8.0 2.00 2.50
M, P, R				
M	BMVW-t	MT20	4.0	4.0
N	BS-t	MT20	3.0	8.0
O	BMVWVW-t	MT20	4.0	9.0
Q	BS-t	MT20	3.0	8.0
S	BMVW-t	MT20	4.0	8.0 2.00 2.25
T	BMV1-p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
		FACTORED GROSS REACTION		MAXIMUM FACTORED DOWN REACTION		INPUT BRG UPLIFT		RECORD BRG IN-SX	
JT	VERT	HORZ		DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
T	1915	0		1915	0	5-8			
K	1789	0		1789	0	0	MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT K. MINIMUM BEARING LENGTH AT JOINT K = 3-8.

UNFACTORED REACTIONS							
JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
T	1352	901 / 0	0 / 0	0 / 0	0 / 0	451 / 0	0 / 0
K	1265	830 / 0	0 / 0	0 / 0	0 / 0	435 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T

BRACING
TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 4.08 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING									
TOTAL LOAD CASES: (4)									
		CHORDS				WEBS			
		MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB. MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)		
FR-TO			FROM TO			FR-TO			
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	S-C	-377 / 0	0.10 (1)	
B-C	-2058 / 0	-91.8	-91.8	0.32 (1)	4.42	C-R	-73 / 0	0.04 (1)	
C-D	-2045 / 0	-91.8	-91.8	0.31 (1)	4.43	R-D	0 / 145	0.04 (4)	
D-E	-2218 / 0	-91.8	-91.8	0.50 (1)	4.08	D-P	0 / 827	0.19 (1)	
E-F	-2199 / 0	-91.8	-91.8	0.50 (1)	4.08	P-E	-527 / 0	0.41 (1)	
F-G	-2189 / 0	-91.8	-91.8	0.50 (1)	4.08	E-O	-29 / 0	0.01 (1)	
G-H	-2199 / 0	-91.8	-91.8	0.49 (1)	4.09	O-G	-547 / 0	0.43 (1)	
H-I	-1881 / 0	-91.8	-91.8	0.28 (1)	4.52	O-H	0 / 879	0.20 (1)	
I-J	-1885 / 0	-91.8	-91.8	0.28 (1)	4.61	M-H	0 / 86	0.03 (4)	
T-B	-1879 / 0	0.0	0.0	0.19 (1)	6.12	M-I	0 / 43	0.01 (1)	
K-J	-1758 / 0	0.0	0.0	0.19 (1)	6.29	L-I	-493 / 0	0.13 (1)	
T-S	0 / 0	-18.5	-18.5	0.07 (4)	10.00	B-S	0 / 1789	0.40 (1)	
S-R	0 / 1731	-18.5	-18.5	0.33 (1)	10.00	L-J	0 / 1691	0.38 (1)	
R-Q	0 / 1681	-18.5	-18.5	0.33 (1)	10.00				
Q-P	0 / 1681	-18.5	-18.5	0.33 (1)	10.00				
P-O	0 / 2218	-18.5	-18.5	0.41 (1)	10.00				
O-N	0 / 1628	-18.5	-18.5	0.32 (1)	10.00				
N-M	0 / 1628	-18.5	-18.5	0.32 (1)	10.00				
M-L	0 / 1596	-18.5	-18.5	0.31 (1)	10.00				
L-K	0 / 0	-18.5	-18.5	0.08 (4)	10.00				

TOTAL WEIGHT = 143 lb [M]

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 28.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.0W/12
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2018
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.08")
CALCULATED VERT. DEFL.(TL) = L/999 (0.10")

CSI: TC=0.50/1.00 (D-E:1), BC=0.41/1.00 (O-P:1), WB=0.43/1.00 (G-O:1), SS=0.24/1.00 (D-E:1)
DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.88 (D) (INPUT = 0.90)
JSI METAL = 0.52 (Q) (INPUT = 1.00)



Structural component only
DWG# T-2007922

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408313	T35	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 08:10:18 2020 Page 1
ID:CMCubINVR6TstFos31v6l_zns11-GosFzeEnc2aiBW_kZjv6D83kRjwBEIMTPaPa02zLbrL

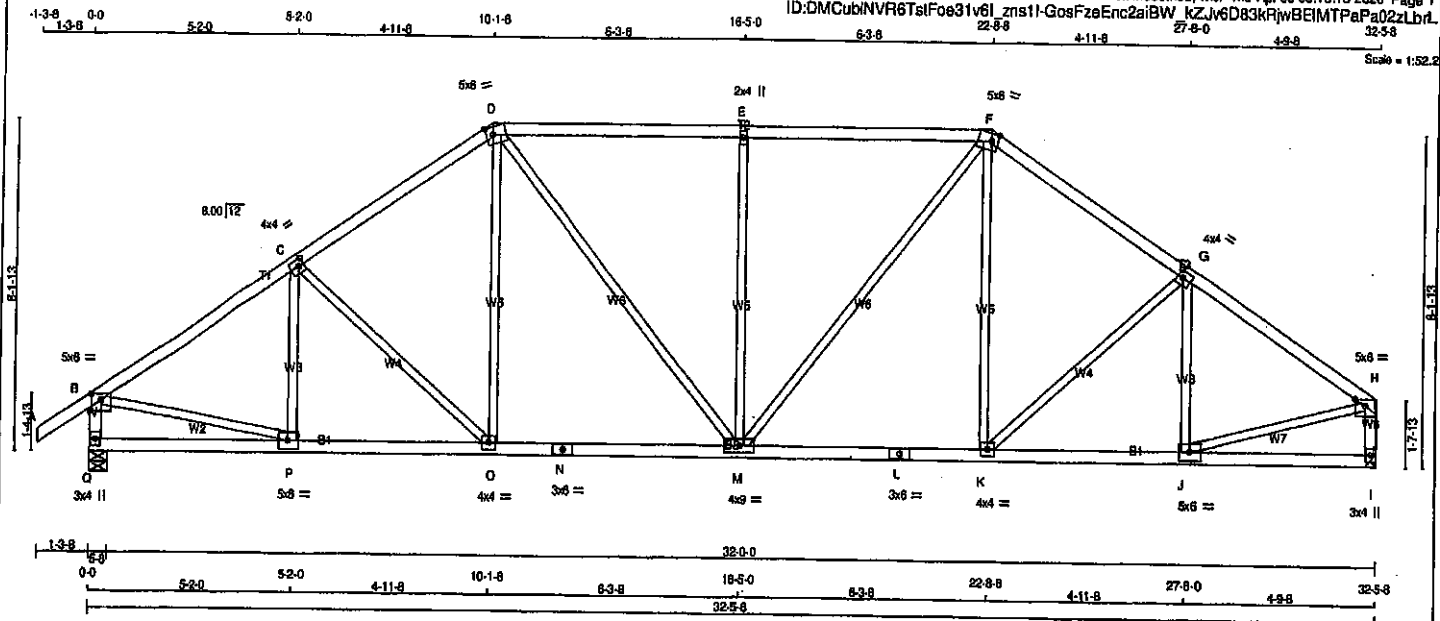

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
Q - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
L - I	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
			SPF

DRY: SEASONED LUMBER.

PLATES (tables in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	8.0	1.75 3.00
C	TMVW-t	MT20	4.0	4.0	2.00 1.50
D	TTWW-m	MT20	5.0	6.0	2.25 2.00
E	TMVW-w	MT20	2.0	4.0	
F	TTWW-m	MT20	5.0	6.0	2.25 2.00
G	TMVW-t	MT20	4.0	4.0	2.00 1.50
H	TMVW-p	MT20	5.0	8.0	Edge
I	BMV1-p	MT20	3.0	4.0	
J	BMVW-t	MT20	5.0	8.0	
K	BMVW-t	MT20	4.0	4.0	
L	BS-t	MT20	3.0	8.0	
M	BMVW-w	MT20	4.0	9.0	
N	BS-t	MT20	3.0	8.0	
O	BMVW-t	MT20	4.0	4.0	
P	BMVW-t	MT20	5.0	6.0	
Q	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORIZ	BRG	BRG	IN-SX	IN-SX
Q	1915	0	1915	0	0	5-8	5-8		
I	1789	0	1789	0	0	MECHANICAL			

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERMALIVE	WIND	DEAD	SOIL
Q	1352	801 / 0	0 / 0	0 / 0	0 / 0	451 / 0	0 / 0
I	1265	830 / 0	0 / 0	0 / 0	0 / 0	435 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.27 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-81.8 -81.8	0.12 (1)	10.00	P-C	-277 / 0	0.10 (1)
B-C	-2117 / 0	-81.8 -81.8	0.37 (1)	4.33	C-O	-259 / 0	0.22 (1)
C-D	-1948 / 0	-81.8 -81.8	0.36 (1)	4.49	O-D	0 / 280	0.06 (1)
D-E	-1910 / 0	-81.8 -81.8	0.53 (1)	4.27	D-M	0 / 502	0.11 (1)
E-F	-1910 / 0	-81.8 -81.8	0.53 (1)	4.27	M-E	-708 / 0	0.91 (1)
F-G	-1907 / 0	-81.8 -81.8	0.33 (1)	4.58	M-F	0 / 555	0.12 (1)
G-H	-1987 / 0	-81.8 -81.8	0.33 (1)	4.48	K-F	0 / 213	0.05 (4)
Q-B	-1873 / 0	0.0 0.0	0.19 (1)	6.13	K-G	-168 / 0	0.14 (1)
I-H	-1751 / 0	0.0 0.0	0.19 (1)	6.30	J-G	-374 / 0	0.13 (1)
Q-P	0 / 0	-18.5 -18.5	0.10 (4)	10.00	B-P	0 / 1824	0.41 (1)
P-O	0 / 1786	-18.5 -18.5	0.35 (1)	10.00	J-H	0 / 1741	0.39 (1)
O-N	0 / 1596	-18.5 -18.5	0.33 (1)	10.00			
N-M	0 / 1596	-18.5 -18.5	0.33 (1)	10.00			
M-L	0 / 1563	-18.5 -18.5	0.33 (1)	10.00			
L-K	0 / 1678	-18.5 -18.5	0.34 (1)	10.00			
K-J	0 / 0	-18.5 -18.5	0.09 (4)	10.00			

TOTAL WEIGHT = 143 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.08")
CALCULATED VERT. DEFL. (LL) = L/999 (0.08")
ALLOWABLE DEFL. (TL) = L/360 (1.08")
CALCULATED VERT. DEFL. (TL) = L/999 (0.18")

CSK: TC=0.53/1.00 (E-F:1), BC=0.35/1.00 (O-P:1), WB=0.91/1.00 (E-M:1), SS=0.28/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1897 788 1897 1858

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.90 (J) (INPUT = 0.90)
JSI METAL= 0.51 (L) (INPUT = 1.00)

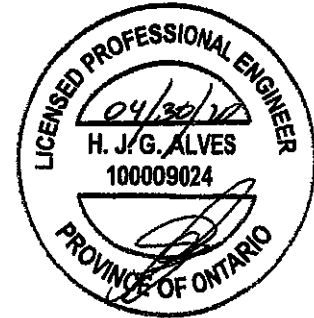

Structural component only
DWG# T-2007923

JOB NAME 408313	TRUSS NAME T36	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 08:10:18 2020 Page 1
ID:DMCubINVRGtstFoe31v6l_zns11-CB_00K328tqQp87hkyalZ94VWc0IH3mtuuh5wzLbrJ
20-9-8 25-8-0 32-5-8
Scale = 1:54.0

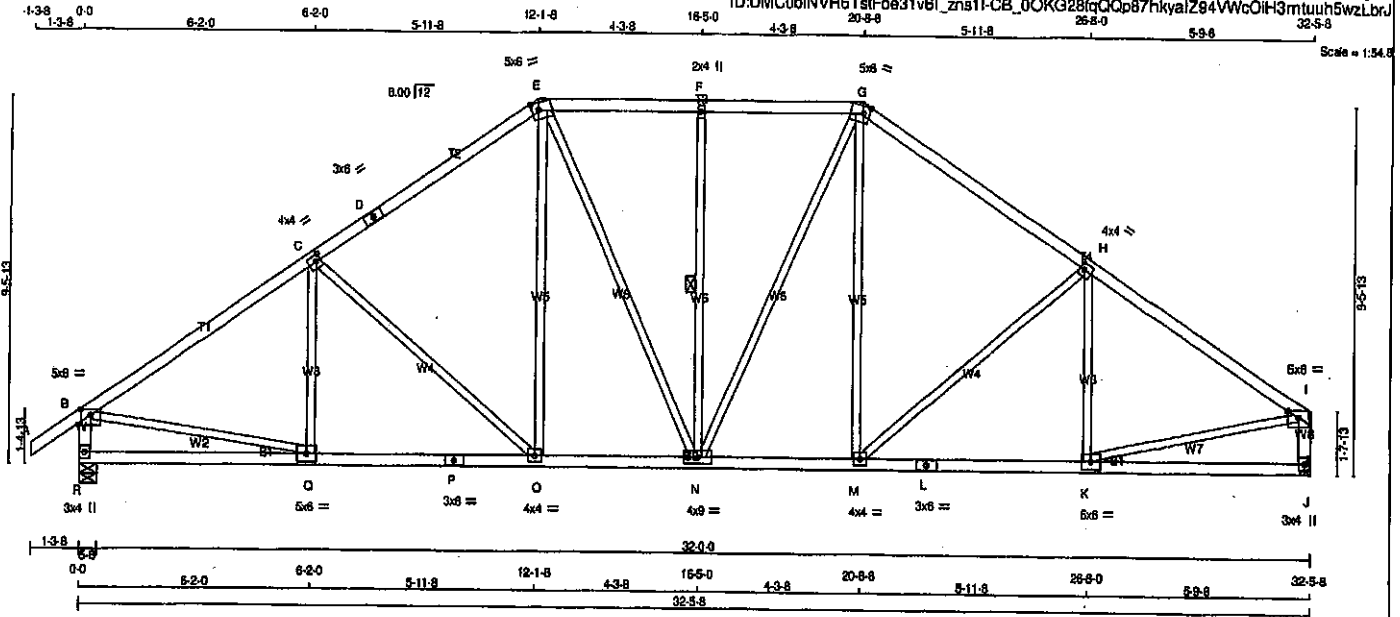

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
J - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - N	2x4	DRY	No.2
N - O	2x4	DRY	No.2
O - P	2x4	DRY	No.2
P - Q	2x4	DRY	No.2
Q - R	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	8.0	1.75 3.00
C	TMVW-f	MT20	4.0	4.0	2.00 1.50
D	TS-t	MT20	3.0	6.0	
E	TTWW-m	MT20	5.0	8.0	2.25 2.00
F	TMVW-w	MT20	2.0	4.0	
G	TTWW-m	MT20	5.0	8.0	2.25 2.00
H	TMVW-f	MT20	4.0	4.0	2.00 1.50
I	TMVW-p	MT20	5.0	8.0	Edge
J	BMV1-p	MT20	3.0	4.0	
K	BMVW-t	MT20	5.0	8.0	
L	BS-t	MT20	3.0	6.0	
M	BMVW-f	MT20	4.0	4.0	
N	BMVW-w	MT20	4.0	4.0	
O	BMVW-t	MT20	4.0	4.0	
P	BS-t	MT20	3.0	6.0	
Q	BMVW-f	MT20	5.0	8.0	
R	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
R	1915	0	1915	0	0	5-8	5-8
J	1789	0	1789	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1352	801 / 0	0 / 0	0 / 0	0 / 0	451 / 0	0 / 0
J	1285	830 / 0	0 / 0	0 / 0	0 / 0	435 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.09 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	C-C	-192 / 38	0.09 (1)
B-C	-2141 / 0	-91.8	-91.8 0.58 (1)	4.09	C-O	-435 / 0	0.58 (1)
C-D	-1820 / 0	-91.8	-91.8 0.51 (1)	4.42	O-E	0 / 381	0.09 (1)
D-E	-1820 / 0	-91.8	-91.8 0.51 (1)	4.42	E-N	0 / 275	0.08 (1)
E-F	-1602 / 0	-91.8	-91.8 0.24 (1)	4.99	N-F	-474 / 0	0.28 (1)
F-G	-1602 / 0	-91.8	-91.8 0.24 (1)	4.99	N-G	0 / 320	0.07 (1)
G-H	-1798 / 0	-91.8	-91.8 0.48 (1)	4.48	M-G	0 / 323	0.07 (1)
H-I	-2036 / 0	-91.8	-91.8 0.49 (1)	4.25	M-H	-344 / 0	0.46 (1)
R-B	-1868 / 0	0.0	0.0 0.19 (1)	8.13	K-H	-275 / 6	0.13 (1)
J-I	-1745 / 0	0.0	0.0 0.19 (1)	8.31	B-Q	0 / 1839	0.41 (1)
					K-I	0 / 1789	0.40 (1)
R-Q	0 / 0	-18.5	-18.5 0.17 (4)	10.00			
Q-P	0 / 1812	-18.5	-18.5 0.37 (1)	10.00			
P-O	0 / 1812	-18.5	-18.5 0.37 (1)	10.00			
O-N	0 / 1488	-18.5	-18.5 0.29 (1)	10.00			
N-M	0 / 1487	-18.5	-18.5 0.29 (1)	10.00			
M-L	0 / 1724	-18.5	-18.5 0.35 (1)	10.00			
L-K	0 / 1724	-18.5	-18.5 0.35 (1)	10.00			
K-J	0 / 0	-18.5	-18.5 0.15 (4)	10.00			

TOTAL WEIGHT = 152 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")
CALCULATED VERT. DEFL.(LL) = L/998 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.08")
CALCULATED VERT. DEFL.(TL) = L/998 (0.15")

CSI: TC=0.58/1.00 (B-C-I), BC=0.37/1.00 (O-Q-I),
WB=0.58/1.00 (C-O-I), SSI=0.23/1.00 (B-C-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1697 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (K) (INPUT = 0.90)

JSI METAL = 0.59 (F) (INPUT = 1.00)




Structural component only
DWG# T-2007924

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408313	T37	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 08:10:19 2020 Page 1
ID:DMCubINVR6TatFos31v6I_znst11-hNYObgHguzyH2zJERTpmhBawxyRnuv5XdFdMzLbrt

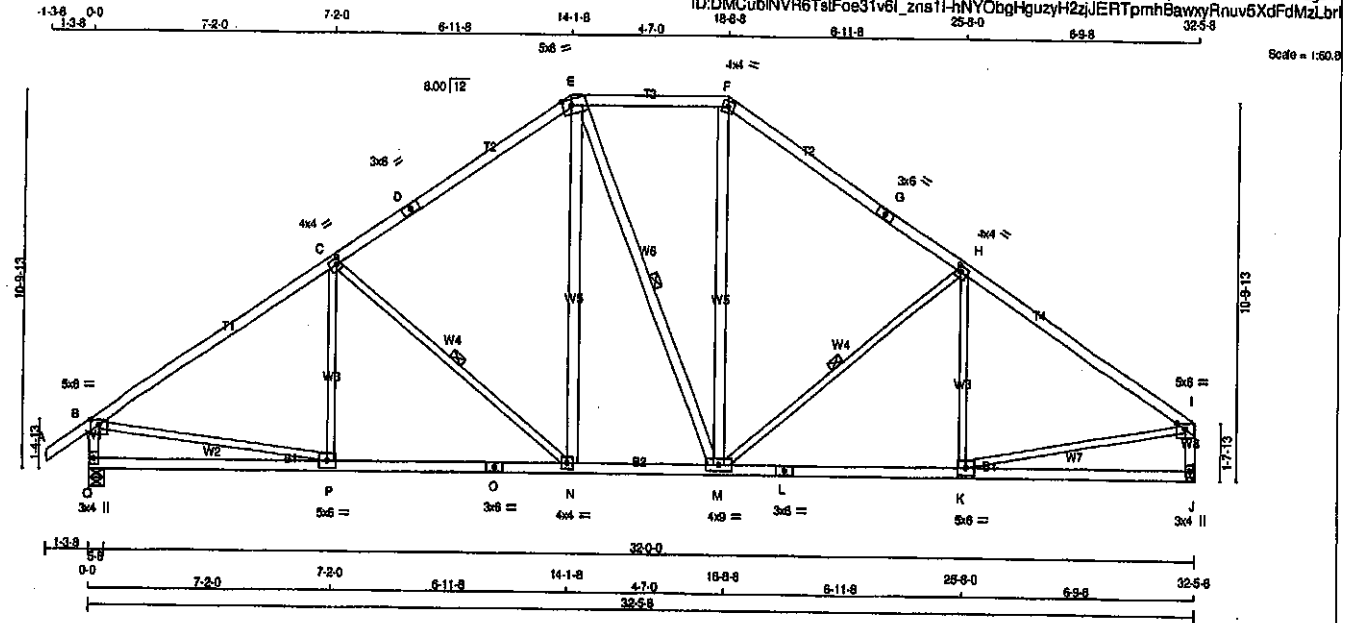

TOTAL WEIGHT = 4 X 155 = 622 lb

CHORDS	SIZE	DRY	LUMLER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
I - J	2x4	DRY	No.2	SPF
J - K	2x4	DRY	No.2	SPF
K - L	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
N - E	2x4	DRY	No.2	SPF
E - M	2x4	DRY	No.2	SPF
M - F	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	1.75	3.00
C TMVW-t	MT20	4.0	4.0	2.00	1.50
D TS-1	MT20	3.0	6.0		
E TTW-m	MT20	5.0	8.0	2.00	3.00
F TTW-m	MT20	4.0	4.0		
G TS-4	MT20	3.0	6.0		
H TMVW-t	MT20	4.0	4.0	2.00	1.50
I TMVW-p	MT20	5.0	8.0	Edge	
J BMV1-p	MT20	3.0	4.0		
K BMVW-t	MT20	5.0	8.0		
L BS-1	MT20	3.0	6.0		
M BMVW-t	MT20	4.0	4.0		
N BMVW-t	MT20	4.0	4.0		
O BS-1	MT20	3.0	6.0		
P BMVW-t	MT20	5.0	8.0		
Q BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
Q	1915	0	1915	0	5-8	5-8
J	1789	0	1789	0	MECHANICAL	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
		SNOW	LIVE			
Q	1352	801 / 0	0 / 0	0 / 0	451 / 0	0 / 0
J	1265	830 / 0	0 / 0	0 / 0	436 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, E-M, H-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	P-C	-123 / 79	0.07 (1)
B-C	-2140 / 0	-91.8	-91.8 0.79 (1)	3.75	C-N	-597 / 0	0.35 (1)
C-D	-1676 / 0	-91.8	-91.8 0.70 (1)	4.24	N-E	0 / 477	0.08 (1)
D-E	-1676 / 0	-91.8	-91.8 0.70 (1)	4.24	E-M	-20 / 0	0.01 (1)
E-F	-1355 / 0	-91.8	-91.8 0.27 (1)	5.28	M-F	0 / 449	0.07 (1)
F-G	-1865 / 0	-91.8	-91.8 0.68 (1)	4.30	M-H	-514 / 0	0.30 (1)
G-H	-1865 / 0	-91.8	-91.8 0.68 (1)	4.30	K-H	-197 / 50	0.12 (1)
H-I	-2054 / 0	-91.8	-91.8 0.71 (1)	3.92	B-P	0 / 1837	0.41 (1)
Q-B	-1862 / 0	0.0	0.0 0.19 (1)	6.15	K-I	0 / 1779	0.40 (1)
J-I	-1739 / 0	0.0	0.0 0.18 (1)	6.32			
Q-P	0 / 0	-18.5	-18.5 0.24 (4)	10.00			
P-O	0 / 1817	-18.5	-18.5 0.41 (1)	10.00			
O-N	0 / 1817	-18.5	-18.5 0.41 (1)	10.00			
N-M	0 / 1363	-18.5	-18.5 0.29 (1)	10.00			
M-L	0 / 1745	-18.5	-18.5 0.39 (1)	10.00			
L-K	0 / 1745	-18.5	-18.5 0.39 (1)	10.00			
K-J	0 / 0	-18.5	-18.5 0.22 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019

- PART 9 OF NBC 2012 (2019 AMENDMENT)

- CSA 086-09, CSA 086-14

- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")

CALCULATED VERT. DEFL.(LL) = L/999 (0.08")

ALLOWABLE DEFL.(TL) = L/360 (1.08")

CALCULATED VERT. DEFL.(TL) = L/999 (0.17")

CSI: TC=0.79/1.00 (B-C:1), BC=0.41/1.00 (N-P:1),

WB=0.41/1.00 (B-P:1), SS=0.26/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 818 354 1887 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.88 (B) (INPUT = 0.90)

JSI METAL = 0.62 (C) (INPUT = 1.00)

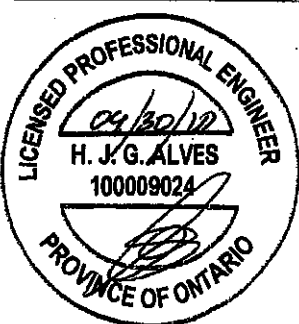

Structural component only
DWG# T-2007925

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408313	T38	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

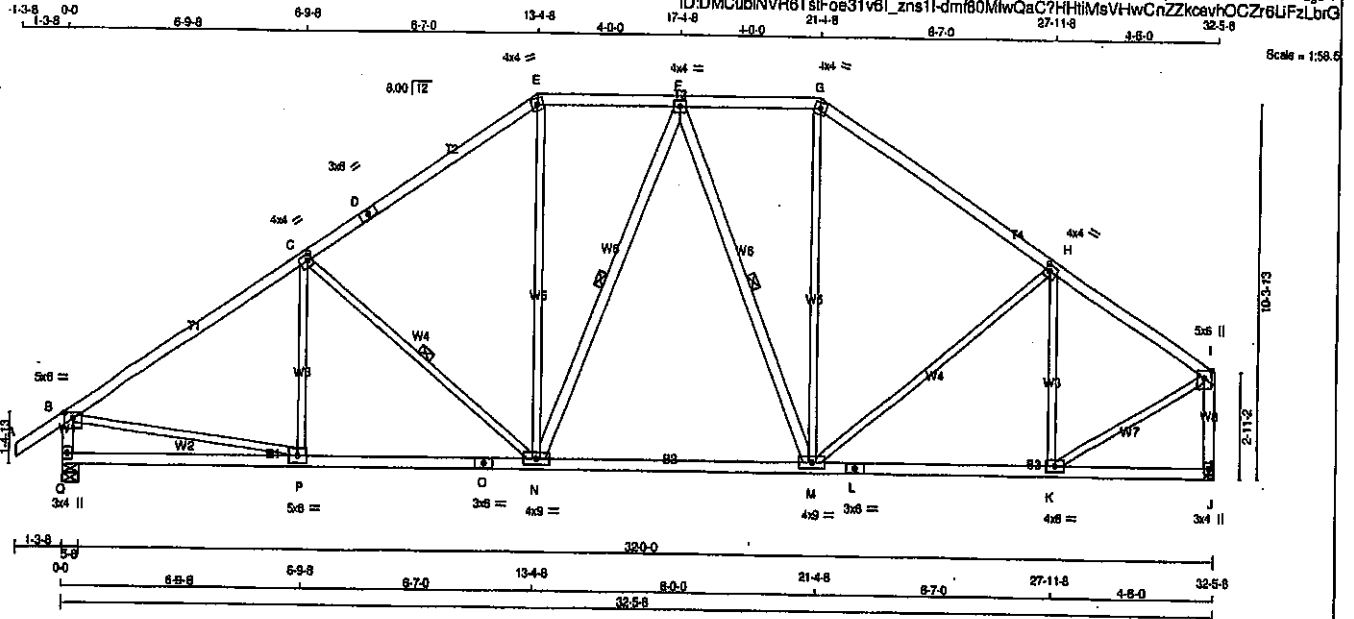

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
Q - B	2x4	DRY	No.2
J - I	2x4	DRY	No.2
Q - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
N - F	2x4	DRY	No.2
F - M	2x4	DRY	No.2

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	X
B	TMVW-p	MT20	5.0	6.0	1.75 3.00
C	TMVW-i	MT20	4.0	4.0	2.00 1.50
D	TS-i	MT20	3.0	6.0	
E	TTW-m	MT20	4.0	4.0	
F	TMVW-i	MT20	4.0	4.0	
G	TTW-m	MT20	4.0	4.0	
H	TMVW-i	MT20	4.0	4.0	2.00 1.50
I	TMVW-p	MT20	5.0	6.0	Edge
J	BMV1-p	MT20	3.0	4.0	
K	BMVW-i	MT20	4.0	6.0	
L	BS-i	MT20	3.0	6.0	
M	BMVW-i	MT20	4.0	9.0	
N	BMVW-i	MT20	4.0	9.0	
O	BS-i	MT20	3.0	6.0	
P	BMVW-i	MT20	5.0	8.0	
Q	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG			
Q	VERT	DOWN	UP	IN-SX	IN-SX		
J	1915	0	1915	0	5-8		
J	1789	0	1789	0	0		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS							
JT	1ST LCASE COMBINED	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD
Q	1352	901 / 0	0 / 0	0 / 0	0 / 0	451 / 0	0 / 0
J	1285	830 / 0	0 / 0	0 / 0	0 / 0	435 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.89 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, F-M, P-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)	
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	P-C	-158 / 55	0.09 (1)
B-C	-2141 / 0	-91.8	-91.8 0.70 (1)	3.89	C-N	-530 / 0	0.28 (1)
C-D	-1737 / 0	-91.8	-91.8 0.62 (1)	4.32	N-E	0 / 570	0.13 (1)
D-E	-1737 / 0	-91.8	-91.8 0.62 (1)	4.32	N-F	-101 / 3	0.08 (1)
E-F	-1415 / 0	-91.8	-91.8 0.20 (1)	5.29	F-M	-371 / 0	0.23 (1)
F-G	-1317 / 0	-91.8	-91.8 0.20 (1)	5.43	M-G	0 / 487	0.11 (1)
G-H	-1811 / 0	-91.8	-91.8 0.54 (1)	4.58	M-H	0 / 13	0.00 (4)
H-I	-1530 / 0	-91.8	-91.8 0.43 (1)	4.81	K-H	-653 / 0	0.38 (1)
Q-B	-1863 / 0	0.0	0.0 0.19 (1)	6.14	B-P	0 / 1838	0.41 (1)
J-I	-1758 / 0	0.0	0.0 0.27 (1)	6.29	K-I	0 / 1517	0.34 (1)
Q-P	0 / 0	-18.5	-18.5 0.19 (4)	10.00			
P-O	0 / 1815	-18.5	-18.5 0.40 (1)	10.00			
O-N	0 / 1815	-18.5	-18.5 0.40 (1)	10.00			
N-M	0 / 1462	-18.5	-18.5 0.35 (1)	10.00			
M-L	0 / 1312	-18.5	-18.5 0.33 (1)	10.00			
L-K	0 / 1312	-18.5	-18.5 0.33 (1)	10.00			
K-J	0 / 0	-18.5	-18.5 0.12 (4)	10.00			

TOTAL WEIGHT = 3 X 157 = 471 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")
CALCULATED VERT. DEFL.(LL) = U/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (1.08")
CALCULATED VERT. DEFL.(TL) = U/999 (0.17")

CSI: TC=0.70/1.00 (B-C:1), BC=0.40/1.00 (N-P:1), WS=0.41/1.00 (B-P:1), SS=0.25/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1867 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (K) (INPUT = 0.90)
JSI METAL= 0.91 (I) (INPUT = 1.00)

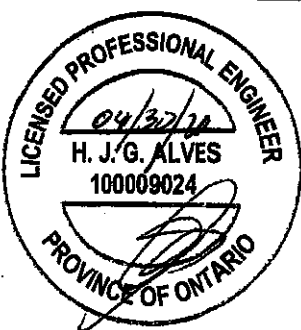

Structural component only
DWG# T-2007926

Tamarack Root Truss, Burlington


Version 8.310 S Oct 28 2019 MTek Industries, Inc. Thu Apr 30 08:10:22 2020 Page 1

ID:DMCubNVR6TsIFoa31v6l_zns11-SyDXEhJYbKsvRSuwZOWTPJm07ue6PMaVsvEhzLbrF

1-3-8 0-0 5-7-8 5-7-8 10-9-14 15-0-12 15-11-0 17-0-12 21-0-2 3-11-8 5-2-6 26-2-9 31-10-0 31-1-8

1-3-8 5-7-8 5-2-6 4-2-14 10-4 1-1-12 3-11-8 5-2-6 26-2-9 31-10-0 31-1-8

Scale: 1/2" = 1'-0"

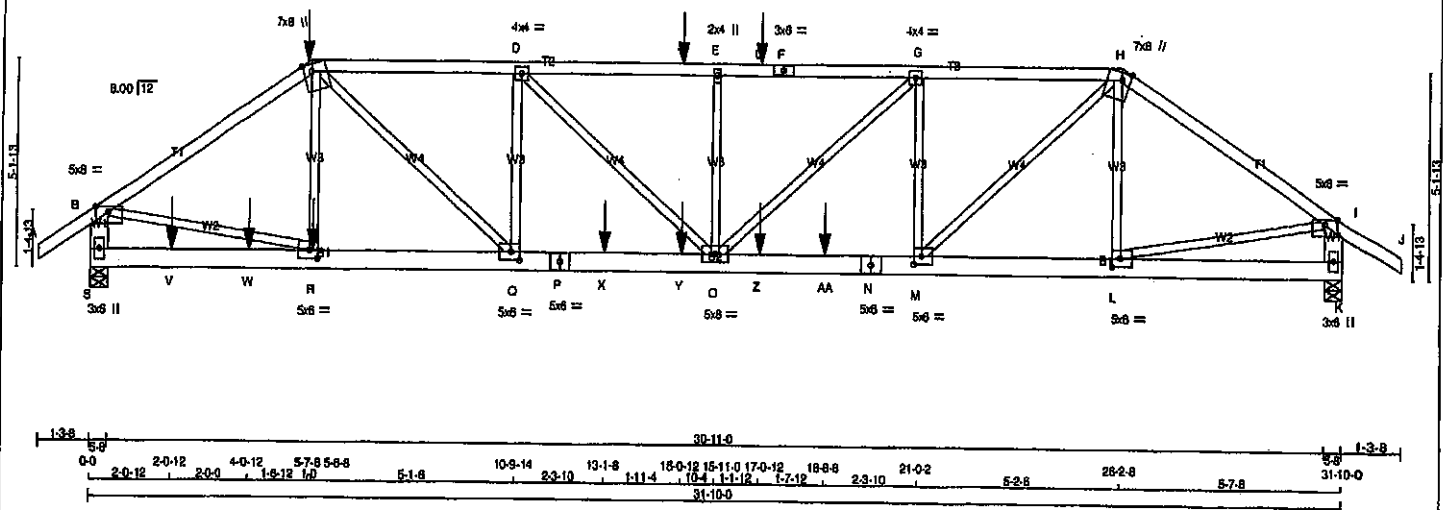

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY; SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS						
FACTORED			MAXIMUM FACTORED		INPUT	RECORD
GROSS REACTION			GROSS REACTION		BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
S	4202	0	4202	0	0	5-8
K	3807	0	3807	0	0	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	2992	1893 / 0	0 / 0	0 / 0	0 / 0	994 / 0	0 / 0
K	2541	1722 / 0	0 / 0	0 / 0	0 / 0	819 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S. K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.17 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEB S			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX FACTORED CSI (LC)
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8	-91.8 0.07 (1)	10.00	R-C	0 / 153	0.03 (4)
B-C	-5322 / 0	-91.8	-91.8 0.52 (1)	3.81	C-Q	0 / 3040	0.38 (1)
C-D	-6888 / 0	-91.8	-91.8 0.43 (1)	3.50	Q-D	-1830 / 0	0.31 (1)
D-T	-7840 / 0	-91.8	-91.8 0.61 (7)	3.17	D-O	0 / 1609	0.20 (1)
T-E	-7840 / 0	-91.8	-91.8 0.51 (1)	3.17	O-E	-730 / 0	0.14 (1)
E-U	-7840 / 0	-91.8	-91.8 0.51 (1)	3.17	O-G	0 / 1550	0.19 (1)
U-F	-7840 / 0	-91.8	-91.8 0.51 (1)	3.17	M-G	-1801 / 0	0.30 (1)
F-G	-7840 / 0	-91.8	-91.8 0.51 (1)	3.17	M-H	0 / 4050	0.50 (1)
G-H	-8710 / 0	-91.8	-91.8 0.43 (1)	3.48	L-H	-701 / 0	0.13 (1)
H-I	-4439 / 0	-91.8	-91.8 0.46 (1)	4.14	B-R	0 / 4489	0.56 (1)
I-J	0 / 35	-91.8	-91.8 0.07 (1)	10.00	L-I	0 / 3795	0.47 (1)
S-B	-4113 / 0	0.0	0.0 0.15 (1)	7.03			
K-I	-3537 / 0	0.0	0.0 0.13 (1)	7.45			
S-V	0 / 0	-18.5	-18.5 0.05 (4)	10.00			
V-W	0 / 0	-18.5	-18.5 0.05 (4)	10.00			
W-R	0 / 0	-18.5	-18.5 0.05 (4)	10.00			
R-Q	0 / 4425	-18.5	-18.5 0.21 (1)	10.00			
Q-P	0 / 6887	-18.5	-18.5 0.47 (1)	10.00			
P-X	0 / 6867	-18.5	-18.5 0.47 (1)	10.00			
X-Y	0 / 6867	-18.5	-18.5 0.47 (1)	10.00			
Y-O	0 / 6867	-18.5	-18.5 0.47 (1)	10.00			
O-Z	0 / 8710	-18.5	-18.5 0.87 (1)	10.00			
Z-AA	0 / 6710	-18.5	-18.5 0.67 (1)	10.00			
AA-N	0 / 6710	-18.5	-18.5 0.67 (1)	10.00			
N-M	0 / 9710	-18.5	-18.5 0.67 (1)	10.00			
M-L	0 / 3723	-18.5	-18.5 0.30 (1)	10.00			
L-K	0 / 0	-18.5	-18.5 0.03 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC	LC1	MAX	MAX	FACE	DIR.	TYPE	HEEL	CONN.
C	5-7-8	-345	-345	---	BACK	VERT	TOTAL	---	C1
R	5-8-8	-762	-762	---	BACK	VERT	TOTAL	---	C1
T	15-0-12	-168	-168	---	BACK	VERT	TOTAL	---	C1
U	17-0-12	-168	-168	---	BACK	VERT	TOTAL	---	C1
V	2-0-12	-34	-34	---	BACK	VERT	TOTAL	---	C1
W	4-0-12	-34	-34	---	BACK	VERT	TOTAL	---	C1
X	13-1-8	-762	-762	---	BACK	VERT	TOTAL	---	C1
Y	15-0-12	-34	-34	---	BACK	VERT	TOTAL	---	C1
Z	17-0-12	-34	-34	---	BACK	VERT	TOTAL	---	C1
AA	18-8-8	-1711	-1711	---	BACK	VERT	TOTAL	---	C1

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD			=	39.0 PSF

SPACING is 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 6.00/12

**THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015**

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06")
CALCULATED VERT. DEFL.(LL) = L/999 (0.20")
ALLOWABLE DEFL.(TL) = L/360 (1.06")
CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CSI: TC=0.52/1.00 (B-C:1), BC=0.67/1.00 (M-O:1),
WB=0.58/1.00 (B-R:1), SS=0.32/1.00 (M-O:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (Q) (INPUT = 0.80)
JSI METAL= 0.81 (N) (INPUT = 1.00)

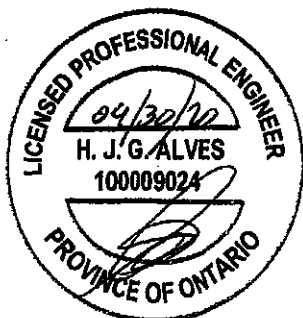

Structural component only
DWG# T-2007927

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408313	T39	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 08:10:22 2020 Page 2
ID:DMCubINVR6TsiFoe31v6l zps1l-5vDXEhJYBuKsvRSuwZOWTPJm07uee6PMoVsvEhzLbrF

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW+m	MT20	7.0	8.0	Edge	2.50
D	TMWW-t	MT20	4.0	4.0		
E	TMW+w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMWW-t	MT20	4.0	4.0		
H	TTWW+m	MT20	7.0	8.0	Edge	2.50
I	TMVW-p	MT20	5.0	8.0	Edge	
K	BMV1+p	MT20	3.0	6.0		
L, M, Q, R						
L	BMWW-t	MT20	5.0	8.0	2.50	2.50
N	BS-t	MT20	5.0	8.0		
O	BMWWW-t	MT20	5.0	8.0		
P	BS-t	MT20	5.0	8.0		
S	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007927

DRWG NO.	
----------	--



JSI GRIP= 0.89 (E) (INPUT = 0.90)
JSI METAL= 0.83 (H) (INPUT = 1.00)

JOB NAME 408313	TRUSS NAME T40	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Pool Truss, Burlington

Version 8.310.5 Oct 29 2019 MITek Industries, Inc. Thu Apr 30 09:10:24 2020 Page 2
ID:DMCubINVR6TstF0a31v6I zns1I-1LLHeNLqVaa8kbH-1 2 YqP6Xcd6wAIFdL?azLbrD

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	6.0	9.0	2.25	4.50
B	TMWW-1	MT20	5.0	6.0		
C	TTW+p	MT20	6.0	9.0	Edge	
D	TMVW-1	MT20	5.0	6.0		
E	TMVW-1	MT20	6.0	9.0	2.25	4.50
F	BMV1+1	MT20	6.0	9.0	Edge	0.50
G	BMWW-1	MT20	7.0	8.0	4.25	3.25
H	BS-1	MT20	5.0	8.0		
I	BMWWW+1	MT20	8.0	9.0		
J	BMWW-1	MT20	7.0	8.0	4.25	3.25
K	BMV1+1	MT20	6.0	9.0	5.50	

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2007928

JOB NAME 408313	TRUSS NAME T41	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

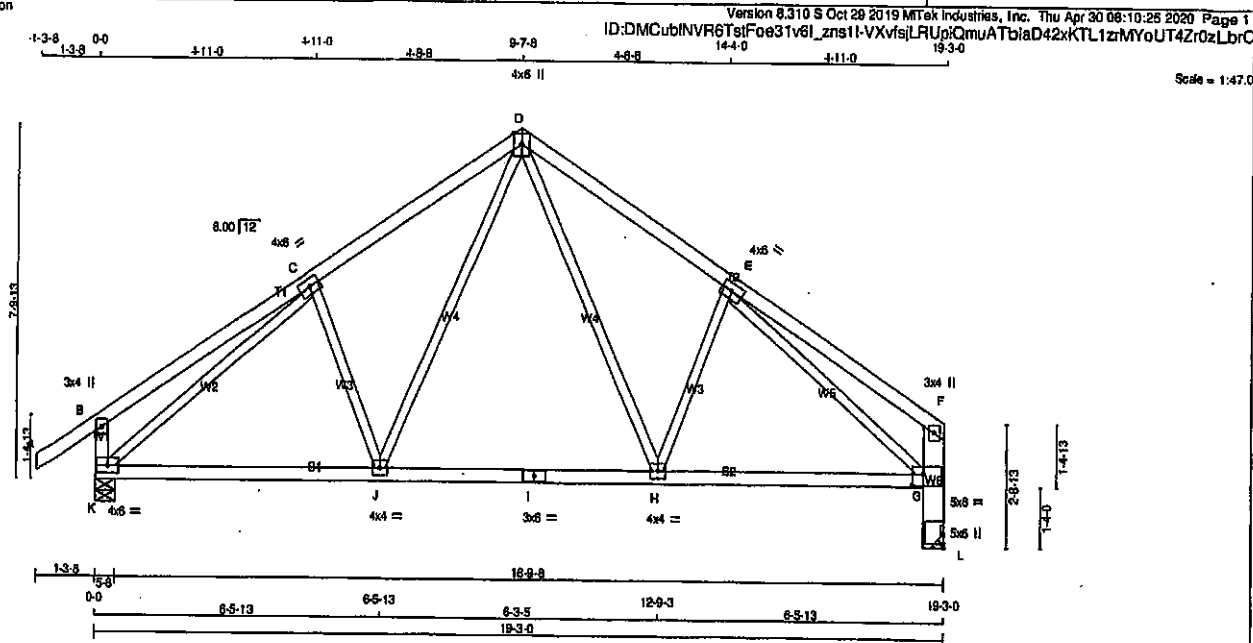

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
K - B	2x4	DRY	No.2
L - F	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMVW-i	MT20	4.0	6.0	
D	TTWW+p	MT20	4.0	8.0	Edge
E	TMVW-i	MT20	4.0	8.0	
F	TMV+p	MT20	3.0	4.0	
G	BMVW-i	MT20	5.0	8.0	3.00 3.00
H	BMVW-i	MT20	4.0	4.0	
I	BS-i	MT20	3.0	6.0	
J	BMVW-i	MT20	4.0	4.0	
K	BMVW-i	MT20	4.0	8.0	
L	EBSP-i	MT20	5.0	8.0	1.00

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED DOWN		INPUT BRG UPLIFT		REQD BRG IN-SX	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
K	1187	0	1187	0	0	5-8		
L	1081	0	1081	0	0	MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT L. MINIMUM BEARING LENGTH AT JOINT L = 3'-8".

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
K	837	583 / 0	0 / 0	0 / 0	0 / 0	274 / 0	0 / 0	
L	750	492 / 0	0 / 0	0 / 0	0 / 0	258 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.84 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS						WEBS					
MEMB.	FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1	MAX LC2	UNBRACED LENGTH	MEMB.	FACTORED FORCE (LBS)	MAX LC1	MAX LC2	UNBRACED LENGTH	
FR-TO		FROM TO				FR-TO					
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	D-H	0 / 424	0.10 (1)			
B-C	0 / 29	-91.8	-91.8	0.34 (1)	10.00	H-E	-282 / 0	0.10 (1)			
C-D	-1040 / 0	-91.8	-91.8	0.38 (1)	5.84	J-D	0 / 424	0.10 (1)			
D-E	-1040 / 0	-91.8	-91.8	0.38 (1)	5.84	C-J	-282 / 0	0.10 (1)			
E-F	0 / 29	-91.8	-91.8	0.34 (1)	10.00	K-C	-1268 / 0	0.91 (1)			
K-B	-293 / 0	0.0	0.0	0.03 (1)	7.81	E-G	-1268 / 0	0.97 (1)			
L-G	-1061 / 0	0.0	0.0	0.08 (1)	7.81						
G-F	-167 / 0	0.0	0.0	0.01 (1)	7.81						
K-J	0 / 946	-18.5	-18.5	0.25 (4)	10.00						
J-I	0 / 878	-18.5	-18.5	0.23 (4)	10.00						
I-H	0 / 878	-18.5	-18.5	0.23 (4)	10.00						
H-G	0 / 946	-18.5	-18.5	0.25 (4)	10.00						

TOTAL WEIGHT = 86 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.64")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.64")
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CS: TC=0.38/1.00 (C-D:1), BC=0.25/1.00 (J-K:4),
WB=0.91/1.00 (C-K:1), SS=0.18/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX	MIN	MAX MIN
MT20	616	354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (E) (INPUT = 0.90)
JSI METAL= 0.33 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007929

JOB NAME 408313	TRUSS NAME G42	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

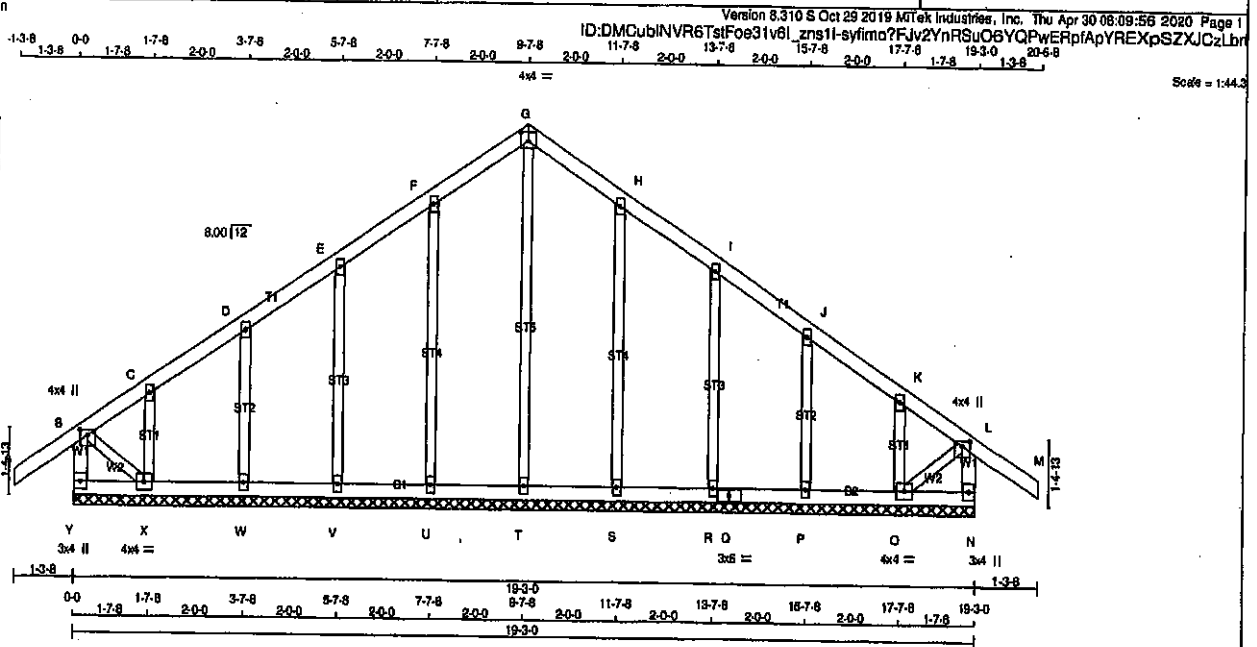

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - G	2x4	DRY	No.2
G - M	2x4	DRY	No.2
Y - B	2x4	DRY	No.2
N - L	2x4	DRY	No.2
Y - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			
GABLE STUDS SPACED AT 2-0-0 OC.			

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMVW+p	MT20	4.0	4.0	1.25 2.00
C, D, E, F, H, I, J, K				
C TMVW+w	MT20	2.0	4.0	
G TTW+p	MT20	4.0	4.0	2.25 2.00
L TMVW+p	MT20	4.0	4.0	1.25 2.00
N BMV1+p	MT20	3.0	4.0	
O BMVW1-t	MT20	4.0	4.0	
P, R, S, T, U, V, W				
P BMV1+w	MT20	2.0	4.0	
Q BS-4	MT20	3.0	8.0	
X BMVW1-t	MT20	4.0	4.0	
Y BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8 -91.8	0.12 (1)	T-G	-139 / 0	0.18 (1)	
B-C	-57 / 0	-91.8 -91.8	0.12 (1)	U-F	-209 / 0	0.14 (1)	
C-D	-19 / 0	-91.8 -91.8	0.05 (1)	V-E	-173 / 0	0.07 (1)	
D-E	-22 / 0	-91.8 -91.8	0.05 (1)	W-D	-186 / 0	0.05 (1)	
E-F	-13 / 0	-91.8 -91.8	0.05 (1)	X-C	-95 / 0	0.02 (1)	
F-G	-23 / 0	-91.8 -91.8	0.05 (1)	S-H	-206 / 0	0.14 (1)	
G-H	-23 / 0	-91.8 -91.8	0.05 (1)	R-I	-173 / 0	0.07 (1)	
H-I	-13 / 0	-91.8 -91.8	0.05 (1)	P-J	-186 / 0	0.05 (1)	
I-J	-22 / 0	-91.8 -91.8	0.05 (1)	Q-K	-99 / 0	0.02 (1)	
J-K	-19 / 0	-91.8 -91.8	0.05 (1)	B-X	0 / 30	0.01 (1)	
K-L	-57 / 0	-91.8 -91.8	0.12 (1)	O-L	0 / 30	0.01 (1)	
L-M	0 / 35	-91.8 -91.8	0.12 (1)				
Y-B	-279 / 0	0.0 0.0	0.03 (1)				
N-L	-279 / 0	0.0 0.0	0.03 (1)				
Y-X	0 / 0	-18.5 -18.5	0.01 (4)				
X-W	0 / 21	-18.5 -18.5	0.02 (4)				
W-V	0 / 18	-18.5 -18.5	0.02 (4)				
V-U	0 / 14	-18.5 -18.5	0.02 (4)				
U-T	0 / 11	-18.5 -18.5	0.01 (4)				
T-S	0 / 11	-18.5 -18.5	0.01 (4)				
S-R	0 / 14	-18.5 -18.5	0.02 (4)				
R-Q	0 / 18	-18.5 -18.5	0.02 (4)				
Q-P	0 / 18	-18.5 -18.5	0.02 (4)				
P-O	0 / 21	-18.5 -18.5	0.02 (4)				
O-N	0 / 0	-18.5 -18.5	0.01 (4)				

TOTAL WEIGHT = 88 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TO=0.12/1.00 (A-B:1), BC=0.02/1.00 (W-X:4), WB=0.18/1.00 (G-T:1), SS=0.08/1.00 (A-B:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (FL)

MAX MIN MAX MIN MAX MIN

MT20 610 354 1887 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.51 (X) (INPUT = 0.90)

JSI METAL= 0.11 (F) (INPUT = 1.00)



Structural component only
DWG# T-2007908

JOB NAME 408313	TRUSS NAME T43	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 08:10:27 2020 Page 1	

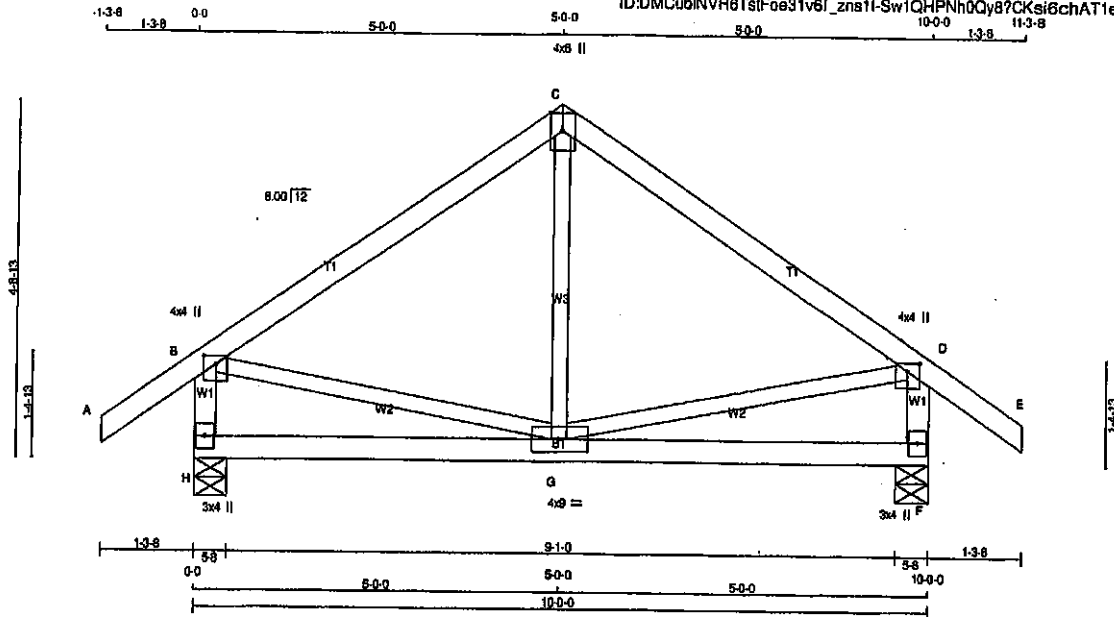

Scale = 1/2" = 1'-0"

LUMBER	N.L.G.A. RULES	CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2		
C - E	2x4	DRY	No.2		
H - B	2x4	DRY	No.2		
F - D	2x4	DRY	No.2		
H - F	2x4	DRY	No.2		

ALL WEBS 2x3 DRY No.2

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TTW+p	MT20	4.0	8.0	Edge	
D	TMVW+p	MT20	4.0	4.0	1.25	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-t	MT20	4.0	9.0		
H	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	UPLIFT
JT	1052	0	1052	0
H	1052	0	1052	0
F	1052	0	1052	0

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	777	328 / 0	0 / 0	0 / 0	0 / 0	450 / 0	0 / 0
F	777	328 / 0	0 / 0	0 / 0	0 / 0	450 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.21 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)
FR-TO		FROM	TO			FR-TO		FROM	TO	
A-B	0 / 35	-91.8	-91.8	0.15 (1)	10.00	G-C	0 / 471	0.18 (4)		
B-C	-707 / 0	-91.8	-91.8	0.50 (1)	6.21	B-G	0 / 802	0.18 (4)		
C-D	-707 / 0	-91.8	-91.8	0.50 (1)	6.21	G-D	0 / 802	0.18 (4)		
D-E	0 / 35	-91.8	-91.8	0.15 (1)	10.00					
H-B	-875 / 0	0.0	0.0	0.11 (1)	7.81					
F-D	-875 / 0	0.0	0.0	0.11 (1)	7.81					
H-G	0 / 0	-93.5	-93.5	0.73 (4)	10.00					
G-F	0 / 0	-93.5	-93.5	0.73 (4)	10.00					

TOTAL WEIGHT = 42 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

*** NON STANDARD GIRDER ***
ADDTL. USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 066-09, CSA 056-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.33")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.33")
CALCULATED VERT. DEFL. (TL) = L/999 (0.07")

CSI: TC=0.50/1.00 (B-C:1), BC=0.73/1.00 (G-H:4), WB=0.18/1.00 (C-G:4), SB=0.43/1.00 (G-H:4)

DOL LUMBER=0.93 NAIL=0.93 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)
MAX	MIN	MAX
MT20	618	354
	1867	788
	1987	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.77 (B) (INPUT = 0.90)
JSI METAL = 0.23 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007930

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408313	G43	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 08:08:57 2020 Page 1
ID:OMCubiNVR6TstFoe31v6l_zns1f1-K8D4_80W4APPb15yp3iy8ncZ2W2Hw8g26I4rezLbre

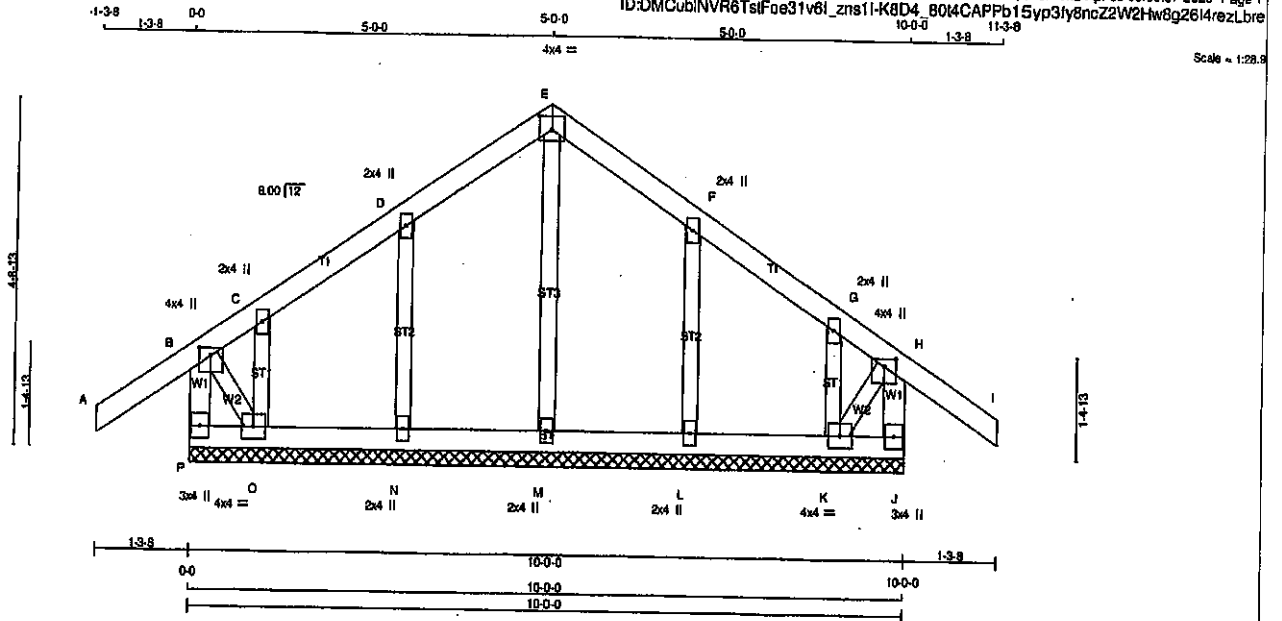

LUMBER			
N. L. G. A. RULES	SIZE	DRY	NO.2
CHORDS	2x4	DRY	No.2
P - B	2x4	DRY	No.2
A - E	2x4	DRY	No.2
E - I	2x4	DRY	No.2
J - H	2x4	DRY	No.2
P - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.25	2.00
C, D, F, G					
C TMVW+w	MT20	2.0	4.0		
E TTW+p	MT20	4.0	4.0	2.25	2.00
H TMVW+p	MT20	4.0	4.0	1.25	2.00
J BMV1+p	MT20	3.0	4.0		
K BMVW1-i	MT20	4.0	4.0		
L, M, N					
L BMV1+w	MT20	2.0	4.0		
O BMVW1-i	MT20	4.0	4.0		
P BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
P-B	-282 / 0	0.0	0.0	0.03 (1)	7.81	M-E	-151 / 0
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	N-D	-221 / 0
B-C	-54 / 0	-91.8	-91.8	0.12 (1)	8.25	O-C	-33 / 0
C-D	0 / 4	-91.8	-91.8	0.08 (1)	10.00	L-F	-221 / 0
D-E	-10 / 0	-91.8	-91.8	0.08 (1)	8.25	K-G	-33 / 0
E-F	-10 / 0	-91.8	-91.8	0.08 (1)	8.25	B-O	0 / 9
F-G	0 / 4	-91.8	-91.8	0.08 (1)	10.00	K-H	0 / 9
G-H	-54 / 0	-91.8	-91.8	0.12 (1)	8.25		
H-I	0 / 35	-91.8	-91.8	0.12 (1)	10.00		
J-H	-282 / 0	0.0	0.0	0.03 (1)	7.81		
P-O	0 / 0	-18.5	-18.5	0.01 (4)	10.00		
O-N	0 / 5	-18.5	-18.5	0.02 (4)	10.00		
N-M	-1 / 0	-18.5	-18.5	0.02 (4)	10.00		
M-L	-1 / 0	-18.5	-18.5	0.02 (4)	10.00		
L-K	0 / 5	-18.5	-18.5	0.02 (4)	10.00		
K-J	0 / 0	-18.5	-18.5	0.01 (4)	10.00		

TOTAL WEIGHT = 43 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TO=0.12/1.00 (H-1:1), BC=0.02/1.00 (K-L:4), WB=0.05/1.00 (E-M:1), SSI=0.08/1.00 (H-1:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)	(PLI)
		MAX MIN	MAX MIN
MT20	618	354	1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.18 (H) (INPUT = 0.90)
JSI METAL=0.11 (F) (INPUT = 1.00)



Structural component only
DWG# T-2007909

JOB NAME 408313	TRUSS NAME T44	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

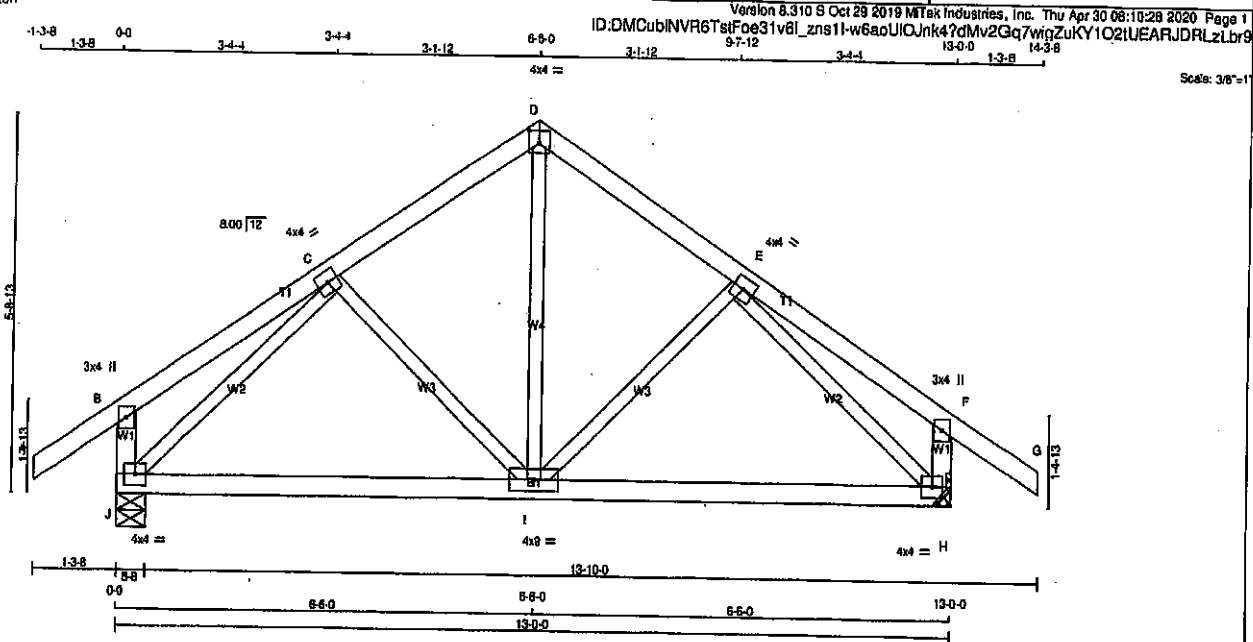

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS	2x4	DRY	No.2
A - D	2x4	DRY	No.2
O - G	2x4	DRY	No.2
J - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (Table in inches)				
JT TYPE	PLATES	W	LEN Y	X
B TMV+0	MT20	3.0	4.0	
C TMVW-1	MT20	4.0	4.0	
D TTW-p	MT20	4.0	4.0	2.25 2.00
E TMVW-1	MT20	4.0	4.0	
F TMV+0	MT20	3.0	4.0	
H BMVW-1	MT20	4.0	4.0	
I BMVW-1	MT20	4.0	9.0	
J BMVW-1	MT20	4.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG	UP-LIFT	IN-SX	IN-SX	5-8	5-8
J	843	0	843	0	0	0	0	0	0
H	843	0	843	0	0	0	0	0	0
A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.									

UNFACTORED REACTIONS						
JT	1ST LOASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD
J	594	403 / 0	0 / 0	0 / 0	0 / 0	191 / 0
H	594	403 / 0	0 / 0	0 / 0	0 / 0	191 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING			
TOTAL LOAD CASES: (4)			
CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	FACTORED LC1 MAX CS1 (LC)
FR-TO		FROM	TO
A-B	0 / 35	-91.8	-91.8 0.12 (1)
B-C	0 / 18	-91.8	-91.8 0.15 (1)
C-D	-555 / 0	-91.8	-91.8 0.12 (1)
D-E	-555 / 0	-91.8	-91.8 0.12 (1)
E-F	0 / 18	-91.8	-91.8 0.15 (1)
F-G	0 / 35	-91.8	-91.8 0.12 (1)
J-B	-241 / 0	0.0	0.0 0.02 (1)
H-F	-241 / 0	0.0	0.0 0.02 (1)
J-I	0 / 555	-18.5	-18.5 0.27 (4)
I-H	0 / 555	-18.5	-18.5 0.27 (4)

DESIGN CRITERIA			
SPECIFIED LOADS:			
TOP CH.	LL	=	25.6 PSF
	DL	=	8.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.4 PSF
TOTAL LOAD = 39.0 PSF			

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.43")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.43")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.15/1.00 (E-F-I), BC=0.27/1.00 (H-I-4), WB=0.28/1.00 (E-H-I), SS=0.12/1.00 (D-E-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (C) (INPUT = 0.89)
JSI METAL = 0.28 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007931

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408313	T45S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

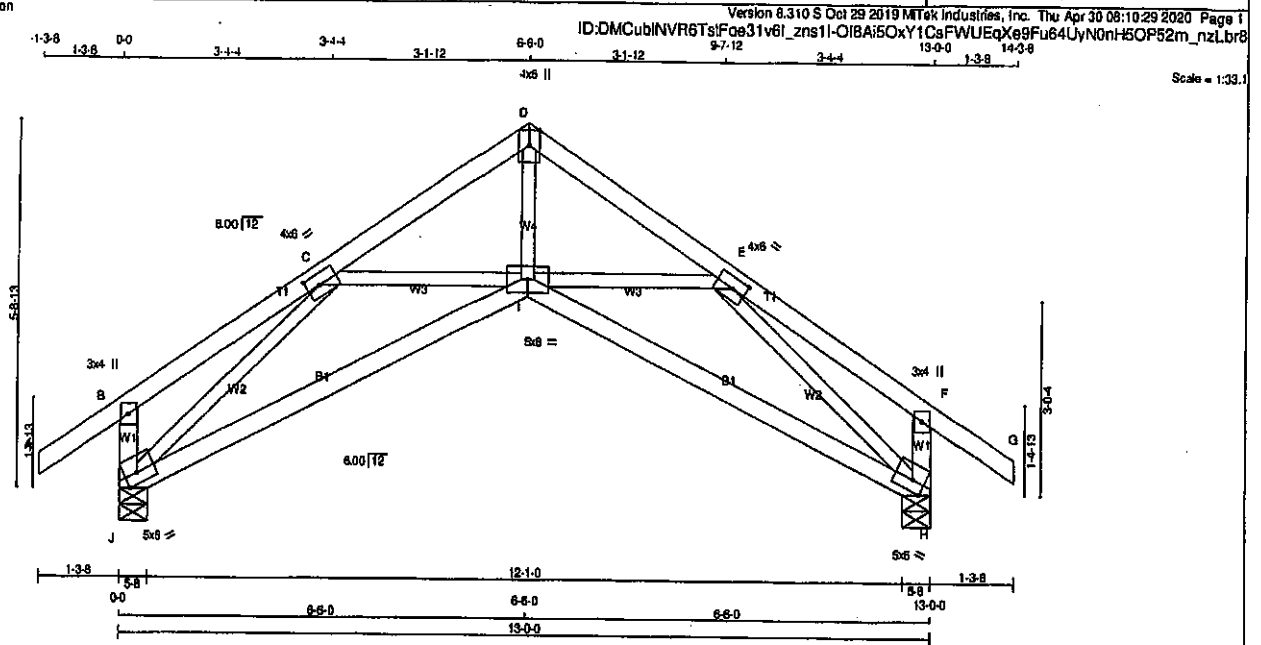

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				TOTAL WEIGHT = 2 X 55 = 110 lb			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.	BEARINGS				DESIGN CRITERIA			
CHORDS											
A - D	2x4	DRY	No.2								
D - G	2x4	DRY	No.2								
J - B	2x4	DRY	No.2								
H - F	2x4	DRY	No.2								
J - I	2x4	DRY	No.2								
I - H	2x4	DRY	No.2								
ALL WEBS	2x3	DRY	No.2								
EXCEPT											

ALL WEBS 2x3 DRY EXCEPT	No.2	SPF	<u>UNFACTORED REACTIONS</u>							TOTAL LOAD = 39.0 PSF	
			1ST CASE	<u>MAX. MIN. COMPONENT REACTIONS</u>						<u>SPACING = 24.0 IN. C/C</u>	
			JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
			J	534	403 / 0	0 / 0	0 / 0	0 / 0	191 / 0	0 / 0	THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015
DRY: SEASONED LUMBER.			H	534	403 / 0	0 / 0	0 / 0	0 / 0	191 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.74 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING				TOTAL LOAD CASES: (4)			
CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD
MEMB.	FORCE (LBS)	FROM TO	LC1 MAX	MEMB.	FORCE (LBS)	FROM TO	LC1 MAX

A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	I-D	0 / 1063	0.24 (1)
B-C	0 / 14	-91.8	-91.8	0.12 (1)	10.00	I-E	0 / 62	0.02 (4)
C-D	-1183 / 0	-91.8	-91.8	0.12 (1)	5.74	C-I	0 / 62	0.02 (4)
D-E	-1183 / 0	-91.8	-91.8	0.12 (1)	5.74	J-C	-1362 / 0	0.49 (1)
E-F	0 / 14	-91.8	-91.8	0.12 (1)	10.00	E-H	-1362 / 0	0.49 (1)
F-G	0 / 35	-91.8	-91.8	0.12 (1)	10.00			
J-B	-251 / 0	0.0	0.0	0.03 (1)	7.81			
H-F	-251 / 0	0.0	0.0	0.03 (1)	7.81			
J-I	0 / 1059	-18.5	-18.5	0.30 (4)	10.00			
I-H	0 / 1059	-18.5	-18.5	0.30 (4)	10.00			

ALLOWABLE DEFL. (LL) = $L/360$ (0.43")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.06")
ALLOWABLE DEFL. (TL) = $L/360$ (0.43")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.14")

CSI: TC=0.12/1.00 (A-B-I), BC=0.30/1.00 (H-I-4),
WB=0.49/1.00 (E-H-I), SS=0.11/1.00 (E-F-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches
PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (J) (INPUT = 0.90)
JSI METAL = 0.35 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007932

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408313	T46	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 08:10:31 2020 Page 1
ID:DMCubINVR6TstFoe31v61_zns1I-KhGw6mQC4ISaUpedxygdKJBPCm6hFWGSPXl2g2Lbr6

Scale = 1:20.4

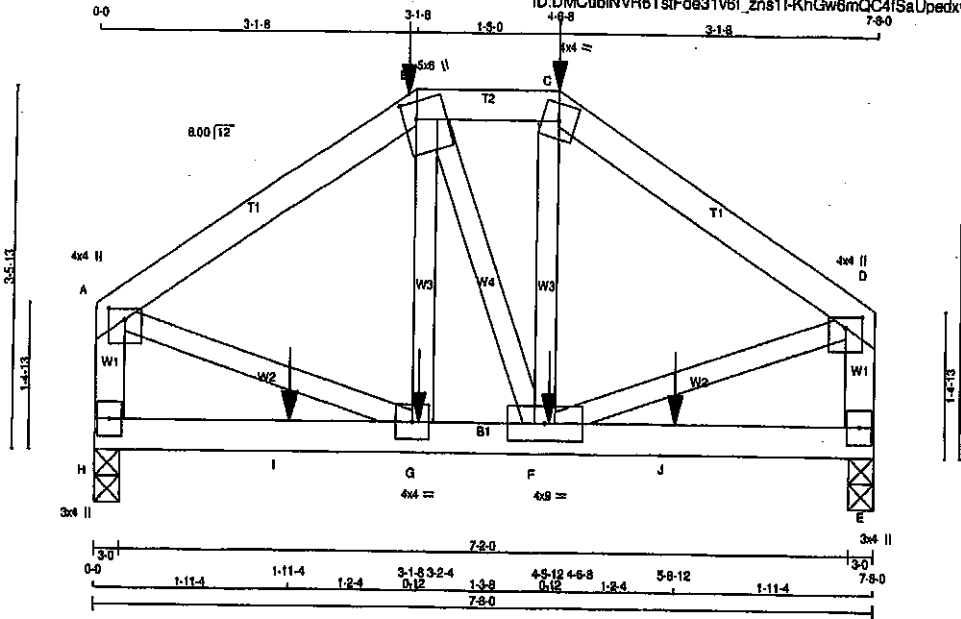

TOTAL WEIGHT = 34 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
H - A	2x4	DRY	No.2
E - D	2x4	DRY	No.2
H - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25 2.00
B	TTWW+m	MT20	5.0	8.0	2.00 1.50
C	TTW-m	MT20	4.0	4.0	
D	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMV1+p	MT20	3.0	4.0	
F	BMVWW-i	MT20	4.0	9.0	
G	BMVWW-i	MT20	4.0	4.0	
H	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	JT	GROSS REACTION	JT	BRG	JT	BRG
H	619 0	H	619 0	H	0 0	H	0 0
E	619 0	E	619 0	E	0 0	E	0 0

UNFACTORED REACTIONS

1ST LOSE		MAX/MIN. COMPONENT REACTIONS	
JT	COMBINED	JT	COMBINED
H	437	H	437
E	437	E	437

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO				FR-TO			
A-B	-535/0	-91.8	-91.8 0.17 (1)	G-B	-84/21	0.02 (1)	0.02 (1)
B-C	-440/0	-91.8	-91.8 0.04 (1)	B-F	-3/0	0.00 (1)	0.00 (1)
C-D	-533/0	-91.8	-91.8 0.17 (1)	F-C	-87/22	0.02 (1)	0.02 (1)
H-A	-580/0	0.0	0.0 0.07 (1)	A-G	0/468	0.12 (1)	0.12 (1)
E-D	-589/0	0.0	0.0 0.07 (1)	F-D	0/467	0.12 (1)	0.12 (1)
H-I	0/0	-18.5	-18.5 0.06 (4)				
I-G	0/0	-18.5	-18.5 0.06 (4)				
G-F	0/441	-18.5	-18.5 0.10 (1)				
F-J	0/0	-18.5	-18.5 0.06 (4)				
J-E	0/0	-18.5	-18.5 0.06 (4)				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
B	3-1-8	-176	-176	---	BACK	VERT	TOTAL	---	C1
C	4-6-8	-176	-176	---	BACK	VERT	TOTAL	---	C1
F	4-5-12	-10	-10	---	BACK	VERT	TOTAL	---	C1
G	3-2-4	-10	-10	---	BACK	VERT	TOTAL	---	C1
I	1-11-4	-10	-10	---	BACK	VERT	TOTAL	---	C1
J	5-8-12	-10	-10	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2018.
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.28")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/660 (0.28")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.17/1.00 (A-B:1), BC=0.10/1.00 (F-G:1), WB=0.12/1.00 (A-G:1), SS=0.10/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRV)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1687
	618	354	1687

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.58 (G) (INPUT = 0.90)
JSI METAL = 0.17 (G) (INPUT = 1.00)




Structural component only
DWG# T-2007933

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408313	T47	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
TRUSS DESC.					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:10:32 2020 Page 1
ID:DMCubINVR6TstFoa31v6l_zms1f-otqJK6RqybR6zCpVgCstWkZJ9RR_lqg53HRa6zLbr5

Scale = 1:30.5

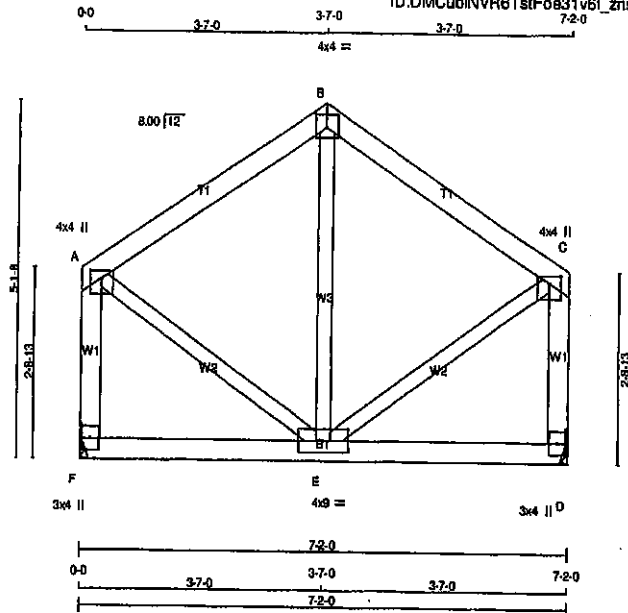

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - B	2x4 DRY	No.2	SPF
B - C	2x4 DRY	No.2	SPF
F - A	2x4 DRY	No.2	SPF
D - C	2x4 DRY	No.2	SPF
F - D	2x4 DRY	No.2	SPF
ALL WEBS EXCEPT	2x3 DRY	No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25 2.00
B	TTW-p	MT20	4.0	4.0	2.25 2.00
C	TMVW+p	MT20	4.0	4.0	1.25 2.00
D	BMV1+p	MT20	3.0	4.0	
E	BMVWW-t	MT20	4.0	9.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	JT	GROSS REACTION	BRG	BRG	BRG	BRG
F	395 0	D	395 0	0	0	0	0
D	395 0	F	395 0	0	0	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D. MINIMUM BEARING LENGTH AT JOINT F = 1-8, JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	279	183/0	0/0	0/0	0/0	98/0	0/0
D	279	183/0	0/0	0/0	0/0	98/0	0/0

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. (PLF)	MAX. (LC)	MEMB.	FORCE (LBS)	MAX. (LC)	MAX. (LC)
FR-TO		FROM	TO	FR-TO			
A-B	-184/0	-91.8	-91.8 0.15 (1)	E-B	-125/15	0.05 (1)	
B-C	-184/0	-91.8	-91.8 0.15 (1)	A-E	0/184	0.04 (1)	
F-A	-389/0	0.0	0.0 0.05 (1)	E-C	0/184	0.04 (1)	
D-C	-389/0	0.0	0.0 0.05 (1)				
F-E	0/0	-18.5	-18.5 0.07 (4)				10.00
E-D	0/0	-18.5	-18.5 0.07 (4)				10.00

TOTAL WEIGHT = 34 b (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2018 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.24")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.24")
CALCULATED VERT. DEFL. (TL) = L/999 (0.01")

CSI: TC=0.18/1.00 (B-C:1), BC=0.07/1.00 (E-F:4),
WB=0.05/1.00 (B-E:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 798 1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.28 (A) (INPUT = 0.90)
JSI METAL= 0.08 (A) (INPUT = 1.00)




Structural component only
DWG# T-2007934

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408313	T48	2	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:10:33 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-G4OhXSSbGjll7n73Nj5PkGifZic9MzJ0_7ZzLbr4
5-7-8

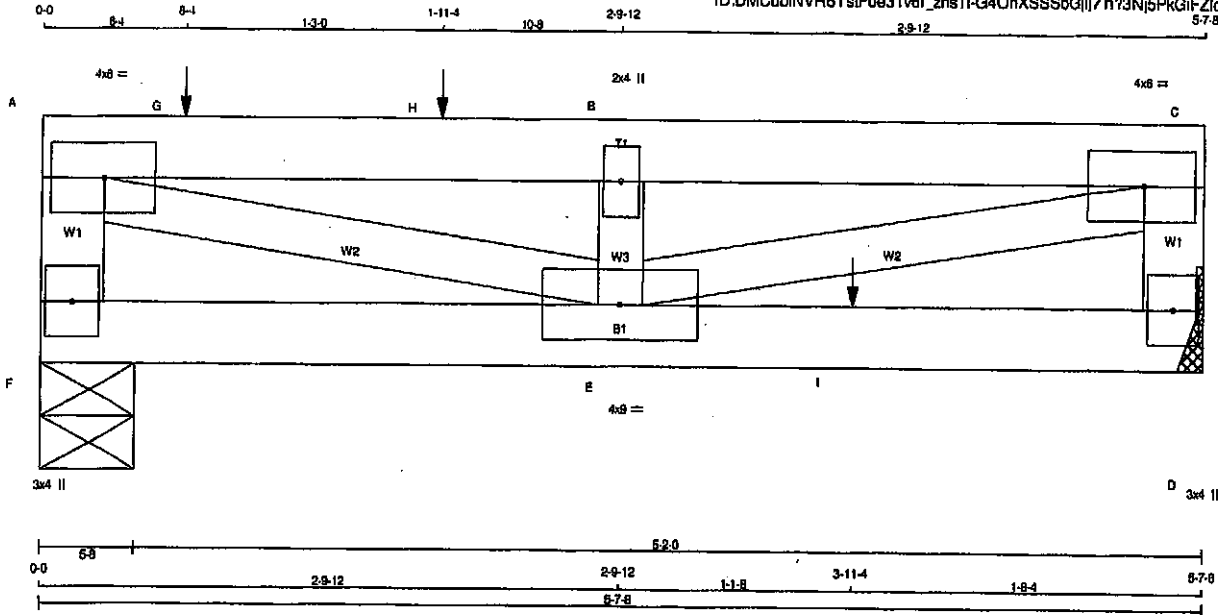

Scale = 1:10.1

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR
F - A	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F-A	12	TOP
A-C	12	TOP
C-D	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F-D	12	SIDE (0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	4.0	8.0	
B	TMVW-w	MT20	2.0	4.0	
C	TMVW-t	MT20	4.0	8.0	
D	BMVW-t	MT20	3.0	4.0	
E	BMVW-w	MT20	4.0	8.0	
F	BMVW-t	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	BRG	BRG
F	952	0	952	0
D	781	0	781	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERMALIVE	WIND	DEAD	SOIL
F	871	448 / 0	0 / 0	0 / 0	0 / 0	222 / 0	0 / 0
D	551	388 / 0	0 / 0	0 / 0	0 / 0	184 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.22 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)	MAX. FACTORED VERT. LOAD (LC4)	MAX. FACTORED VERT. LOAD (LC5)	MAX. FACTORED VERT. LOAD (LC6)	MAX. FACTORED VERT. LOAD (LC7)	MAX. FACTORED VERT. LOAD (LC8)	MAX. FACTORED VERT. LOAD (LC9)	MAX. FACTORED VERT. LOAD (LC10)
FR-TO													
F-A	-929 / 0	0.0	0.0	0.05 (1)	7.81	A-E	0 / 1788	0.22 (1)					
A-G	-1708 / 0	-91.8	-91.8	0.27 (1)	6.22	E-B	-778 / 0	0.08 (1)					
G-H	-1708 / 0	-91.8	-91.8	0.27 (1)	6.22	E-C	0 / 1788	0.22 (1)					
H-B	-1708 / 0	-91.8	-91.8	0.27 (1)	6.22								
B-C	-1708 / 0	-91.8	-91.8	0.12 (1)	6.25								
D-C	-808 / 0	0.0	0.0	0.03 (1)	7.81								
F-E	0 / 0	-18.5	-18.5	0.02 (4)	10.00								
E-I	0 / 0	-18.5	-18.5	0.20 (1)	10.00								
I-D	0 / 0	-18.5	-18.5	0.20 (1)	10.00								

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	8-4	-208	-208	---	TOP	VERT	TOTAL	---	C1
H	1-11-4	-528	-528	---	TOP	VERT	TOTAL	---	C1
I	3-11-4	-377	-377	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 4 X 19 = 75 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 8 OF CBC 2010, OBC 2012, ABC 2019

- PART 9 OF CBC 2012 (2019 AMENDMENT)

- CSA 086-08, CSA 086-14

- TPIC 2011, TPIC 2014

(55 % OF 91.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19')

CALCULATED VERT. DEFL. (LL) = L/999 (0.02')

ALLOWABLE DEFL. (TL) = L/360 (0.19')

CALCULATED VERT. DEFL. (TL) = L/999 (0.04')

CSI: TC=0.27/1.00 (A-B:1), BC=0.20/1.00 (D-E:1),

WB=0.22/1.00 (A-E:1), SSL=0.28/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1887 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.58 (C) (INPUT = 0.90)

JSI METAL = 0.21 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007935

JOB NAME 408313	TRUSS NAME T49	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 M Tek Industries, Inc. Thu Apr 30 08:10:35 2020 Page 1
ID:DMCubINVR6TstF0e31v6l_zns1l-DSWRy8Tt7z0zRkOaolZU9M54NSHB8mGn1V5BRzLbr2

Scale = 1:15.3

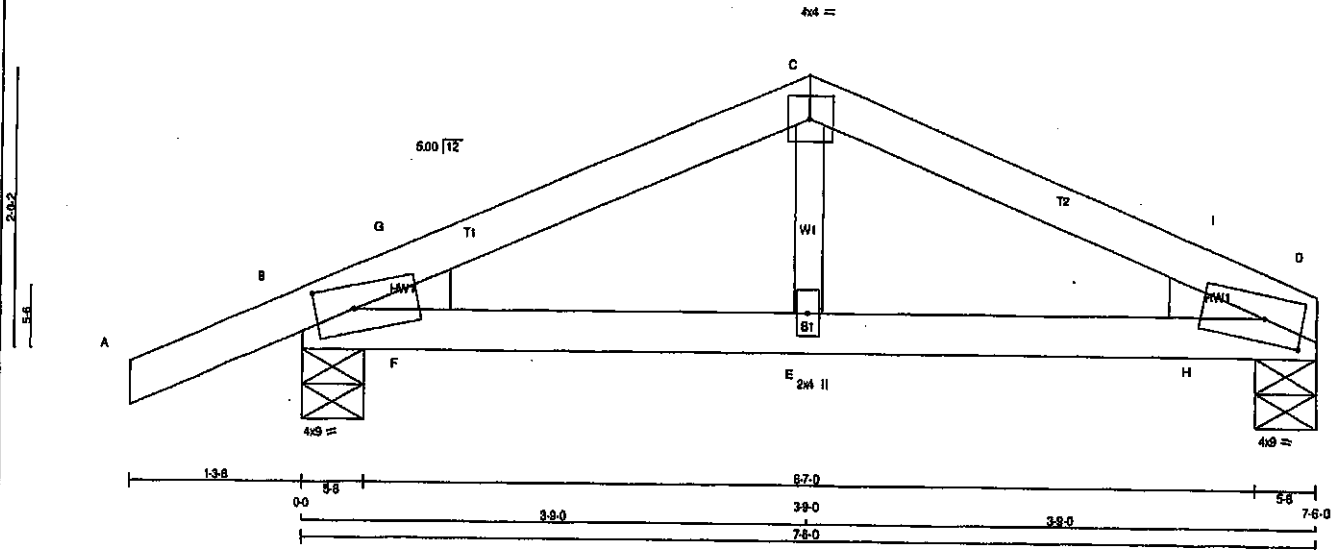

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
B - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	X
B	TMBH1-m	MT20	4.0	9.0	2.00 3.50
C	TTW-p	MT20	4.0	4.0	
D	TMBH1-m	MT20	4.0	9.0	2.00 3.50
E	BMW-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	HEEL		
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	WEDGE
B	537	0	537	0	0	5-8	2x4 L
D	413	0	413	0	0	5-8	2x4 R

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
B	378	281 / 0	0 / 0	0 / 0	0 / 0	117 / 0
D	292	192 / 0	0 / 0	0 / 0	0 / 0	100 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	
FR-TO		FROM TO		FR-TO			
A-B	0 / 18	-91.8 -91.8	0.12 (1)	10.00	E-C	0 / 152	0.03 (1)
B-G	-563 / 0	-91.8 -91.8	0.02 (1)	6.25	F-G	-110 / 8	0.00 (1)
G-C	-538 / 0	-91.8 -91.8	0.11 (1)	6.25	H-I	-110 / 8	0.00 (1)
C-I	-538 / 0	-91.8 -91.8	0.11 (1)	6.25			
I-D	-563 / 0	-91.8 -91.8	0.02 (1)	6.25			
B-F	0 / 493	-18.5 -18.5	0.19 (1)	10.00			
F-E	0 / 493	-18.5 -18.5	0.19 (1)	10.00			
E-H	0 / 493	-18.5 -18.5	0.19 (1)	10.00			
H-D	0 / 493	-18.5 -18.5	0.19 (1)	10.00			

TOTAL WEIGHT = 3 X 22 = 67 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 068-09, CSA 086-14
- TPIC 2011, TPIC 2014

(58% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.25")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01")
ALLOWABLE DEFL. (TL) = $L/360$ (0.25")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.02")

CSI: TC=0.12/1.00 (A-B:1), BC=0.18/1.00 (B-F:1),
WB=0.03/1.00 (C-E:1), SE=0.10/1.00 (C-G:1)

DCL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 384	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (C) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007936

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408313	T49Z	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 08:10:38 2020 Page 1
ID:DMCubINVR6TstFoe31v8l_zns1h13pAUUKuB5tabWakVGor1MuFQnnqwZuQ0hFektzLbr1

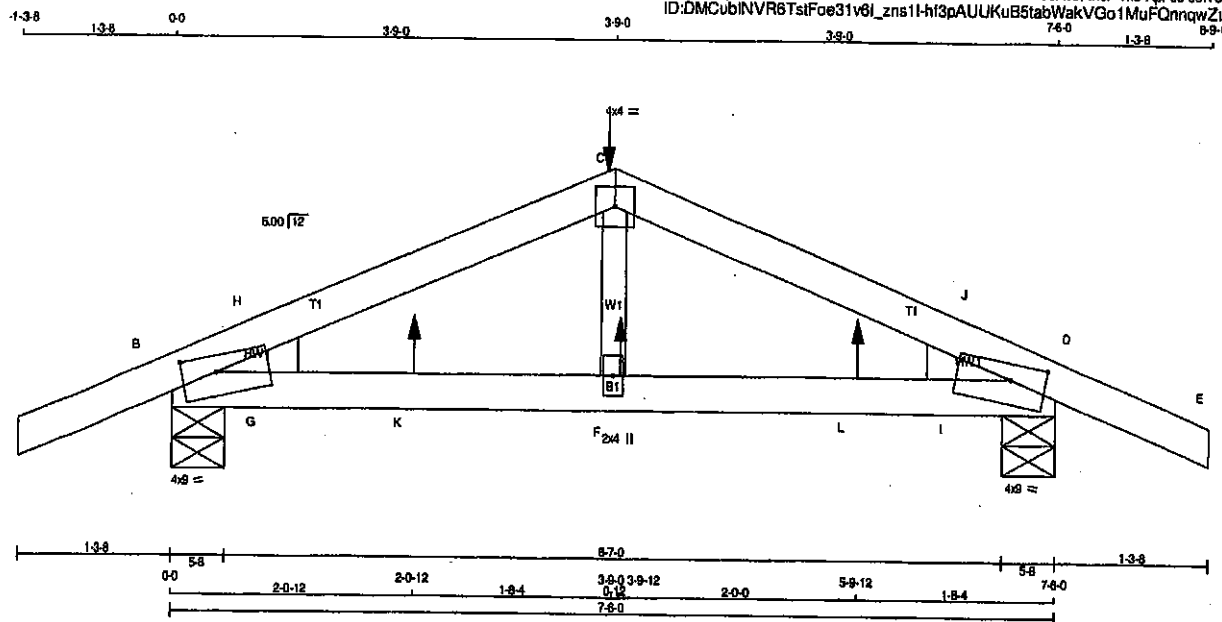

Scale = 1:17.5

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
B - D	2x4	DRY	No.2	SPF	
ALL WEBS		2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.					

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD	HEEL
	GROSS REACTION	GROSS REACTION	BRG	BRG	WEDGE
JT	VERT	HORZ	UP/LIFT	IN-SX	IN-SX
B	875	0	875	0	0
D	874	0	874	0	0

UNFACTORED REACTIONS							
	1ST LC CASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	475	324 / 0	0 / 0	0 / 0	0 / 0	152 / 0	0 / 0
D	475	323 / 0	0 / 0	0 / 0	0 / 0	152 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (7)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX. CSI (LC)	MAX. UNBRACED LENGTH FR-TO	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO	A-B	0 / 18	-91.8	-91.8	0.13 (1)	10.00	F-C	0 / 129	0.04 (4)
	B-H	-881 / 0	-91.8	-91.8	0.04 (1)	6.25	G-H	-90 / 22	0.00 (1)
	H-C	-837 / 0	-91.8	-91.8	0.14 (1)	6.25	I-J	-91 / 22	0.00 (1)
	C-J	-837 / 0	-91.8	-91.8	0.14 (1)	6.25			
	J-D	-881 / 0	-91.8	-91.8	0.04 (1)	6.25			
	D-E	0 / 18	-91.8	-91.8	0.13 (1)	10.00			
	B-G	0 / 770	-24.5	-24.5	0.23 (1)	10.00			
	G-K	0 / 770	-24.5	-24.5	0.23 (1)	10.00			
	K-F	0 / 770	-24.5	-24.5	0.23 (1)	10.00			
	F-L	0 / 770	-24.5	-24.5	0.23 (1)	10.00			
	L-I	0 / 770	-24.5	-24.5	0.23 (1)	10.00			
	I-D	0 / 770	-24.5	-24.5	0.23 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
	G	3-9-0	-259	1	16	FRONT	VERT	TOTAL	---	C1
	F	3-9-12	9	1	16	FRONT	VERT	TOTAL	---	C1
	K	2-0-12	9	1	16	FRONT	VERT	TOTAL	---	C1
	L	5-9-12	9	1	16	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

*** NON STANDARD GIRDER ***

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC0 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.25")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.25")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.02")

CSI: TC=0.14/1.00 (C-H:1), BC=0.23/1.00 (B-G:1),
WB=0.04/1.00 (C-F:4), SS=0.11/1.00 (C-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1867 788 1887 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.30 (C) (INPUT = 0.80)
JSI METAL= 0.14 (D) (INPUT = 1.00)




Structural component only
DWG# T-2007937

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408313	T50	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 08:10:38 2020 Page 1
ID:DMCubINVR6TstF0e31v6i_2ns11-d18abAVbQoLaqugzwIG6n_WOaUROOBIT?k0mzLbr?

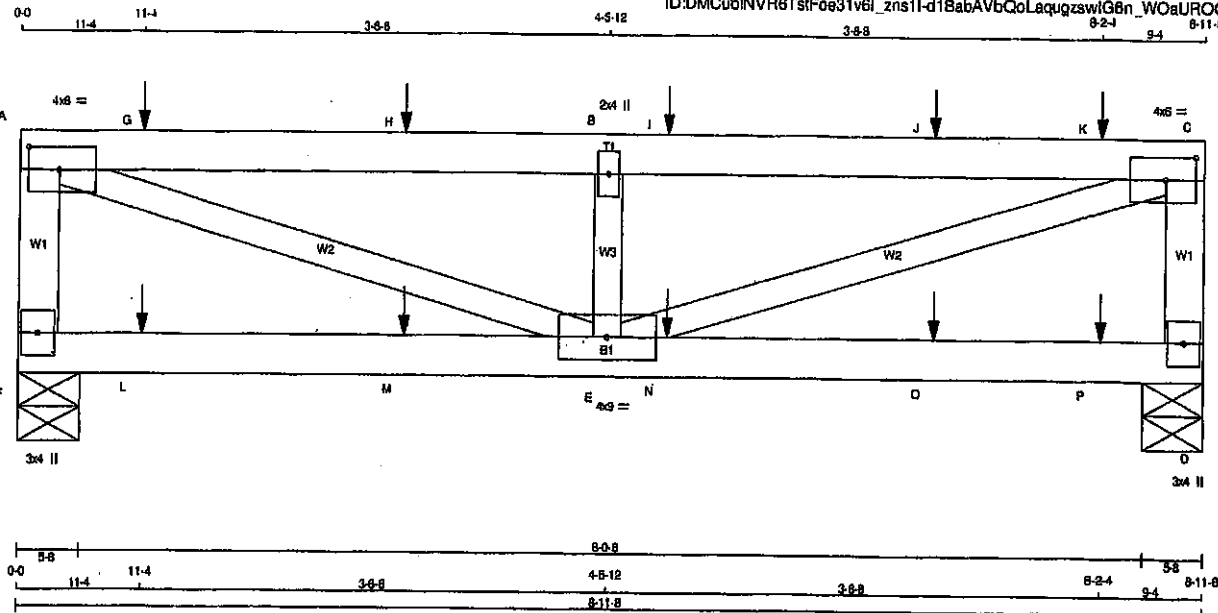

Scale = 1:15.7

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	2x4	DRY	SPF
F - A	2x4	DRY	SPF
A - C	2x4	DRY	SPF
D - C	2x4	DRY	SPF
F - D	2x4	DRY	SPF
ALL WEBS	2x3	DRY	SPF
DRY: SEASONED LUMBER.		No.2	

PLATES (table is in inches)			
JT	TYPE	PLATES	W LEN Y X
A	TMVW-1	MT20	4.0 8.0 2.00 2.75
B	TMVW-1	MT20	2.0 4.0
C	TMVW-1	MT20	4.0 8.0 2.00 2.75
D	BMV-1-p	MT20	3.0 4.0
E	BMVW-1	MT20	4.0 8.0
F	BMV-1-p	MT20	3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORIZ	GROSS REACTION	HORIZ	BRG	IN-SX	BRG	IN-SX
F	803	0	0	803	0	5-8	5-8	5-8	5-8
D	856	0	0	856	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
F	373 / 0	0 / 0	0 / 0	0 / 0	0 / 0	195 / 0	0 / 0
D	605	397 / 0	0 / 0	0 / 0	0 / 0	208 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD LC1	MAX. MAX. (LBS)	MEMB.	FORCE (LBS)	MAX. MAX. (LBS)	CS (LC)
FR-TO		FROM TO	CS (LC)	UNBRAC	FR-TO		
F-A	-719 / 0	0.0	0.0 0.08 (1)	7.81	A-E	0 / 1528	0.38 (1)
A-G	-1450 / 0	-91.8	-91.8 0.50 (1)	4.72	E-B	-740 / 0	0.12 (1)
G-H	-1450 / 0	-91.8	-91.8 0.50 (1)	4.72	E-C	0 / 1528	0.38 (1)
H-B	-1450 / 0	-91.8	-91.8 0.50 (1)	4.72			
B-I	-1450 / 0	-91.8	-91.8 0.50 (1)	4.72			
I-J	-1450 / 0	-91.8	-91.8 0.50 (1)	4.72			
J-K	-1450 / 0	-91.8	-91.8 0.50 (1)	4.72			
K-C	-1450 / 0	-91.8	-91.8 0.50 (1)	4.72			
D-C	-754 / 0	0.0	0.0 0.09 (1)	7.81			
F-L	0 / 0	-18.5	-18.5 0.15 (4)	10.00			
L-M	0 / 0	-18.5	-18.5 0.15 (4)	10.00			
M-E	0 / 0	-18.5	-18.5 0.15 (4)	10.00			
E-N	0 / 0	-18.5	-18.5 0.15 (1)	10.00			
N-O	0 / 0	-18.5	-18.5 0.15 (1)	10.00			
O-P	0 / 0	-18.5	-18.5 0.15 (1)	10.00			
P-D	0 / 0	-18.5	-18.5 0.15 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
G	11'-4"	-85	-85	---	BACK	VERT	TOTAL	---	C1
H	2-11'-4"	-82	-82	---	BACK	VERT	TOTAL	---	C1
I	4-11'-4"	-82	-82	---	BACK	VERT	TOTAL	---	C1
J	6-11'-4"	-82	-82	---	BACK	VERT	TOTAL	---	C1
K	8-2'-4"	-82	-82	---	BACK	VERT	TOTAL	---	C1
L	11'-4"	-50	-50	---	BACK	VERT	TOTAL	---	C1
M	2-11'-4"	-49	-49	---	BACK	VERT	TOTAL	---	C1
N	4-11'-4"	-49	-49	---	BACK	VERT	TOTAL	---	C1
O	6-11'-4"	-49	-49	---	BACK	VERT	TOTAL	---	C1
P	8-2'-4"	-51	-51	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/960 (0.30")
CALCULATED VERT. DEFL. (LL) = L/999 (0.04")
ALLOWABLE DEFL. (TL) = L/960 (0.30")
CALCULATED VERT. DEFL. (TL) = L/999 (0.08")

CSI: TC=0.50/1.00 (A-B:1), SC=0.18/1.00 (D-E:1), WB=0.38/1.00 (A-E:1), SSI=0.34/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (E) (INPUT = 0.90)
JSI METAL= 0.38 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007938

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408314	T59	1	1	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:32:15 2020 Page 1
ID:85G8Bk99WNGszVGuuF_Z1BzizB3-9Z3uofC9_JJzWDKEKq4QAIC8NP3FnxOqHQuP5zLbWk

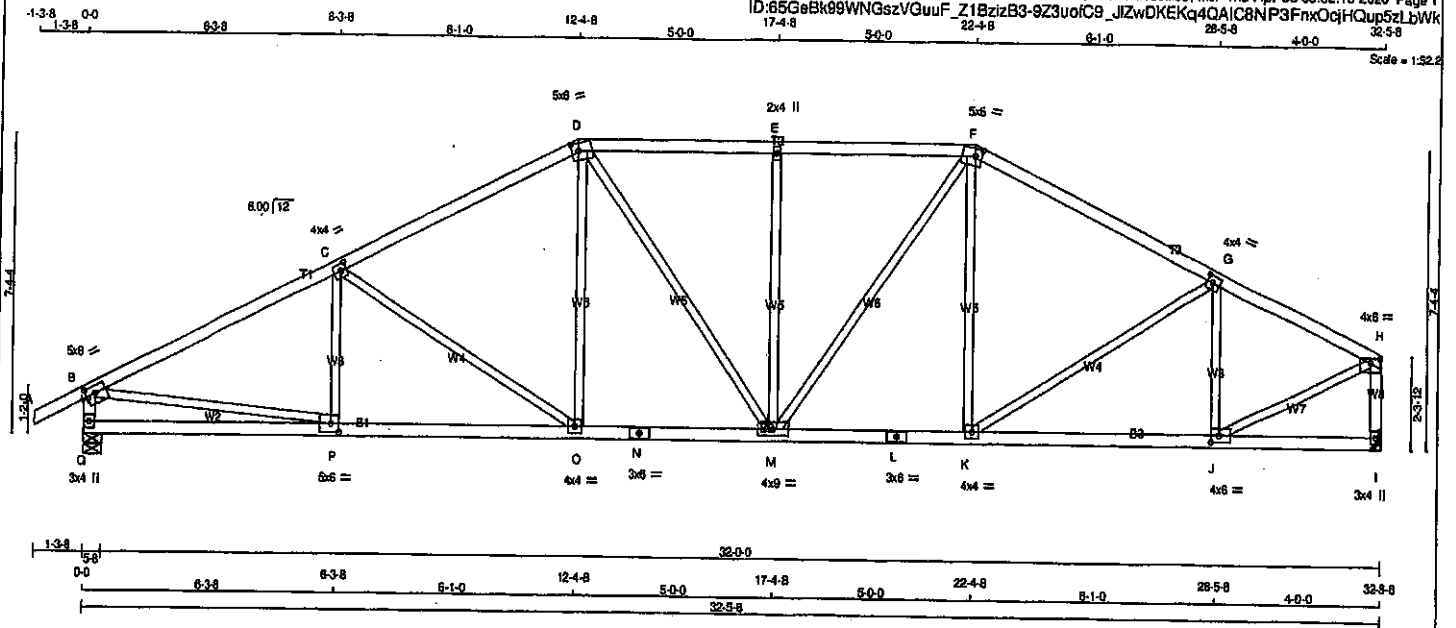

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
J - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - I	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	8.0	2.00	2.75
C	TMVW-t	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	8.0	2.25	2.00
E	TMVW-t	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	8.0	2.25	2.00
G	TMVW-t	MT20	4.0	4.0	2.00	1.75
H	TMVW-p	MT20	4.0	6.0	1.25	3.00
I	BMV1-p	MT20	3.0	4.0		
J	BMVW-t	MT20	4.0	8.0	2.00	2.50
K	BMVW-t	MT20	4.0	4.0		
L	BS-t	MT20	3.0	6.0		
M	BMVW-t	MT20	4.0	9.0		
N	BS-t	MT20	3.0	6.0		
O	BMVW-t	MT20	4.0	4.0		
P	BMVW-t	MT20	5.0	8.0	2.50	2.50
Q	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
Q	1914	0	1914	0
I	1789	0	1789	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
Q	1351	900 / 0	0 / 0	0 / 0	0 / 0	461 / 0	0 / 0
I	1285	830 / 0	0 / 0	0 / 0	0 / 0	435 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.69 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	P-C	-201 / 36	0.08 (1)
B-C	-2635 / 0	-91.8	-91.8 0.50 (1)	3.89	C-D	-523 / 0	0.58 (1)
C-D	-2205 / 0	-91.8	-91.8 0.54 (1)	4.04	D-E	0 / 392	0.09 (1)
D-E	-2087 / 0	-91.8	-91.8 0.34 (1)	4.37	E-F	0 / 237	0.05 (1)
E-F	-2087 / 0	-91.8	-91.8 0.34 (1)	4.37	F-G	-560 / 0	0.54 (1)
F-G	-2004 / 0	-91.8	-91.8 0.47 (1)	4.30	G-H	0 / 545	0.12 (1)
G-H	-1815 / 0	-91.8	-91.8 0.37 (1)	4.58	H-I	0 / 190	0.03 (4)
H-I	-1884 / 0	0.0	0.0 0.19 (1)	5.14	I-J	0 / 139	0.03 (1)
I-J	-1781 / 0	0.0	0.0 0.22 (1)	6.29	J-K	-728 / 0	0.20 (1)
					K-L	0 / 2405	0.54 (1)
Q-P	0 / 0	-18.5	-18.5 0.16 (4)	10.00	L-H	0 / 1851	0.42 (1)
P-O	0 / 2383	-18.5	-18.5 0.45 (1)	10.00			
O-N	0 / 1950	-18.5	-18.5 0.38 (1)	10.00			
N-M	0 / 1950	-18.5	-18.5 0.38 (1)	10.00			
M-L	0 / 1772	-18.5	-18.5 0.38 (1)	10.00			
L-K	0 / 1772	-18.5	-18.5 0.36 (1)	10.00			
K-J	0 / 1855	-18.5	-18.5 0.34 (1)	10.00			
J-I	0 / 0	-18.5	-18.5 0.11 (4)	10.00			

TOTAL WEIGHT = 138 LB (MP)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.08")
CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CSI: TC=0.60/1.00 (B-C:1), BC=0.45/1.00 (O-P:1), WB=0.56/1.00 (C-O:1), SSI=0.25/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLU) (PLU)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.70 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007955

JOB NAME 408314	TRUSS NAME T60	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:32:17 2020 Page 1
ID: 85GeBk99WNGszVGuuF_Z1BzizB3-5x8/DLDPVw?GAWTdsE6uGjHqIdKdFrXvAbv_1zzLbWl
34-9-0 35-0-8 1-3-8
Scale = 1:57.0

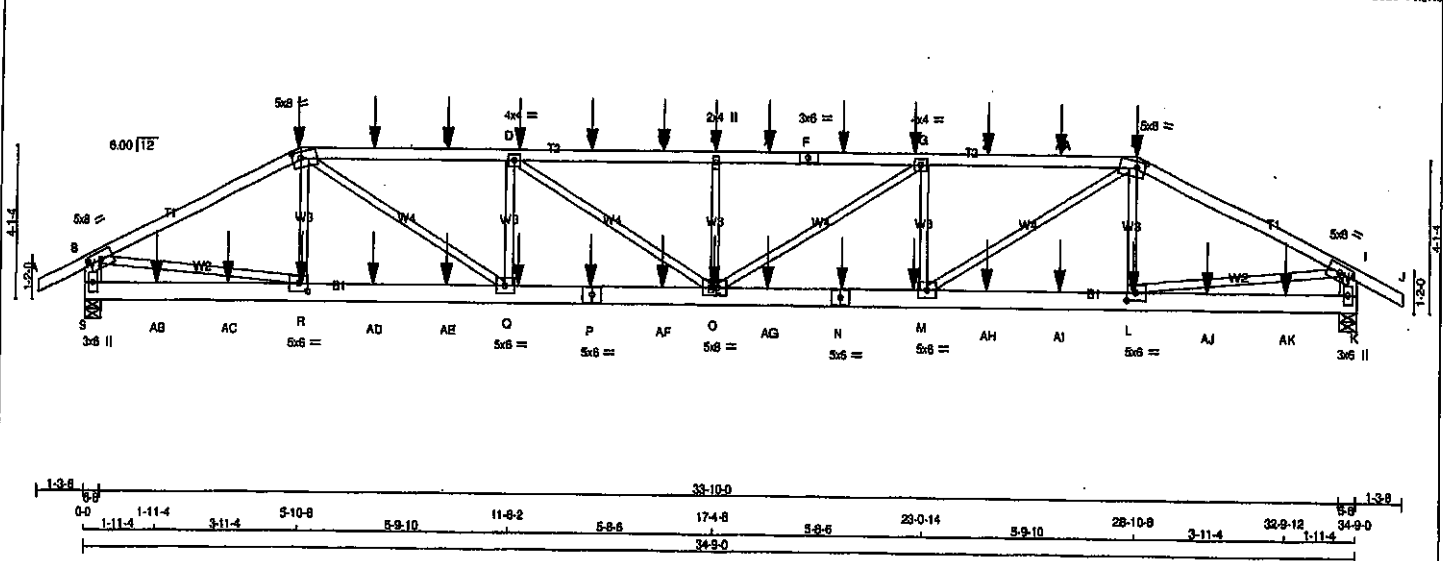

LUMBER N.L.G.A. RULES CHORDS SIZE LUMBER DESCR. A - C 2x4 DRY No.2 SPF C - F 2x4 DRY No.2 SPF F - H 2x4 DRY No.2 SPF H - J 2x4 DRY No.2 SPF J - B 2x6 DRY No.2 SPF B - I 2x6 DRY No.2 SPF I - P 2x6 DRY No.2 SPF P - N 2x6 DRY No.2 SPF N - K 2x6 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT DRY: SEASONED LUMBER. DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS: CHORDS #ROWS SURFACE SPACING (IN) LOAD (PLF) TOP CHORDS : (0.122"x3") SPIRAL NAILS A-C 1 12 SIDE (81.0) C-F 1 12 SIDE (81.0) F-H 1 12 SIDE (81.0) H-J 1 12 SIDE (81.0) S-B 2 12 TOP K-I 2 12 TOP BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS S-P 2 12 SIDE (183.1) P-N 2 12 SIDE (183.1) N-K 2 12 SIDE (183.1) WEBS : (0.122"x3") SPIRAL NAILS 2x3 1 6 NAILS TO BE DRIVEN FROM ONE SIDE ONLY. GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS. TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED MAXIMUM FACTORED INPUT RECORD GROSS REACTION GROSS REACTION BRG BRG DOWN HORZ UPLIFT IN-SX IN-SX JT 2322 0 3282 0 0 5-8 5-8 S 2322 0 3282 0 0 5-8 5-8 K 2322 0 3282 0 0 5-8 5-8 UNFACTORED REACTIONS 1ST CASE MAX/MIN COMPONENT REACTIONS JT COMBINED SNOW LIVE PERMLIVE WIND DEAD SOIL S 2322 1519 / 0 0 / 0 0 / 0 803 / 0 0 / 0 K 2322 1519 / 0 0 / 0 0 / 0 803 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.94 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS MAX. FACTORED FACTORED WEBS MAX. FACTORED MEMB. FORCE VERT. LOAD LC1 MAX. MAX. MEMB. FORCE MAX. (LBS) (PLF) CSI (LC) UNBRAC LENGTH FR-TO (LBS) CSI (LC) FR-TO A-B 0 / 28 -91.8 -91.8 0.07 (1) 10.00 R-C -375 / 33 0.05 (1) B-C -4988 / 0 -91.8 -91.8 0.51 (1) 3.90 C-Q 0 / 3017 0.37 (1) C-T -8988 / 0 -91.8 -91.8 0.71 (1) 3.15 Q-D -1448 / 0 0.18 (1) T-U -8988 / 0 -91.8 -91.8 0.71 (1) 3.15 D-E 0 / 910 0.11 (1) U-D -8988 / 0 -91.8 -91.8 0.71 (1) 3.15 E-O -825 / 0 0.10 (1) D-V -7748 / 0 -91.8 -91.8 0.77 (1) 2.94 O-G -1448 / 0 0.18 (1) V-W -7748 / 0 -91.8 -91.8 0.77 (1) 2.94 G-H -1448 / 0 0.18 (1) W-E -7748 / 0 -91.8 -91.8 0.77 (1) 2.94 H-I 0 / 3017 0.37 (1) E-X -7748 / 0 -91.8 -91.8 0.77 (1) 2.94 I-H -375 / 33 0.05 (1) X-F -7748 / 0 -91.8 -91.8 0.77 (1) 2.94 F-R 0 / 4495 0.58 (1) F-Y -7748 / 0 -91.8 -91.8 0.77 (1) 2.94 Y-L 0 / 4495 0.58 (1) Y-G -7748 / 0 -91.8 -91.8 0.77 (1) 2.94 G-Z -6988 / 0 -91.8 -91.8 0.71 (1) 3.15 Z-AA -6988 / 0 -91.8 -91.8 0.71 (1) 3.15 AA-H -6988 / 0 -91.8 -91.8 0.71 (1) 3.15 H-I -4988 / 0 -91.8 -91.8 0.51 (1) 3.90 I-J 0 / 28 -91.8 -91.8 0.07 (1) 10.00 S-B -3207 / 0 0.0 0.0 0.11 (1) 7.73 K-I -3207 / 0 0.0 0.0 0.11 (1) 7.73 S-AB 0 / 0 -18.5 -18.5 0.06 (4) 10.00 AB-AC 0 / 0 -18.5 -18.5 0.06 (4) 10.00 AC-R 0 / 0 -18.5 -18.5 0.06 (4) 10.00 R-AD 0 / 4447 -18.5 -18.5 0.33 (1) 10.00 AD-AE 0 / 4447 -18.5 -18.5 0.33 (1) 10.00 AE-Q 0 / 4447 -18.5 -18.5 0.33 (1) 10.00 Q-P 0 / 6988 -18.5 -18.5 0.52 (1) 10.00 P-AF 0 / 6988 -18.5 -18.5 0.52 (1) 10.00 AF-O 0 / 6988 -18.5 -18.5 0.52 (1) 10.00 O-AG 0 / 6988 -18.5 -18.5 0.52 (1) 10.00 AG-N 0 / 6988 -18.5 -18.5 0.52 (1) 10.00 N-M 0 / 6988 -18.5 -18.5 0.52 (1) 10.00 MAH 0 / 4447 -18.5 -18.5 0.33 (1) 10.00 AH-AI 0 / 4447 -18.5 -18.5 0.33 (1) 10.00 AI-L 0 / 4447 -18.5 -18.5 0.33 (1) 10.00 L-AJ 0 / 0 -18.5 -18.5 0.06 (4) 10.00 AJ-AK 0 / 0 -18.5 -18.5 0.06 (4) 10.00 AK-K 0 / 0 -18.5 -18.5 0.06 (4) 10.00 FACTORED CONCENTRATED LOADS (LBS) JT LOC. LC1 MAX. MAX. FACE DIR. TYPE HEEL CONN. C 5-10-8 -411 -411 --- FRONT VERT TOTAL --- C1 D 11-11-4 -110 -110 --- FRONT VERT TOTAL --- C1				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.8 PSF DL = 8.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2015, CBC 2012, ABC 2019 - PART 9 OF CBC 2012 (2019 AMENDMENT) - CSA 086-09, CSA 086-14 - TPIC 2011, TPIC 2014 (55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (1.18") CALCULATED VERT. DEFL.(LL) = L/999 (0.24") ALLOWABLE DEFL.(TL)= L/360 (1.18") CALCULATED VERT. DEFL.(TL) = L/918 (0.45") CSI: TC=0.77/1.00 (E-G:1), BC=0.52/1.00 (M-O:1), WB=0.58/1.00 (L-L:1), SSI=0.20/1.00 (C-D:1) DOL LUMBER=1.00 NAIL=1.00 LB SHEAR=1.00 TENS=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00 COMPANION LIVE LOAD FACTOR = 1.00 AUTOSOLVE HELLS OFF TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 818 354 1667 788 1907 1658 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP = 0.89 (R) (INPUT = 0.90) JSI METAL = 0.88 (N) (INPUT = 1.00)			
--	--	--	--	---	--	--	--	---	--	--	--

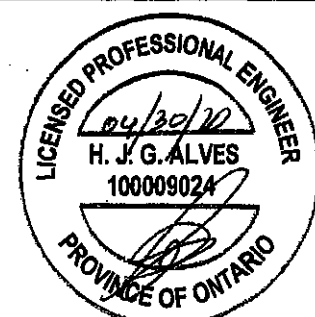

Structural component only
DWG# T-2007956 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408314	T60	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Metek Industries, Inc. Thu Apr 30 08:32:17 2020 Page 2
ID:85GeBk89WN GszVGuuF Z1BzizB3-5x8IDLPVw?GAWTdSE6uGIHQIDkdFrXvAbv IzzLbWi

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW-t	MT20	5.0	8.0		
C	TTWW-m	MT20	5.0	8.0	2.00	2.75
D	TMWW-t	MT20	4.0	4.0		
E	TMW-w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMWW-t	MT20	4.0	4.0		
H	TTWW-m	MT20	5.0	8.0	2.00	2.75
I	TMW-t	MT20	5.0	8.0		
K	BMV-t-p	MT20	3.0	6.0		
L	BMWW-t	MT20	5.0	6.0	2.50	2.75
M	BMWW-t	MT20	5.0	6.0		
N	BS-t	MT20	5.0	6.0		
O	BMWW-t	MT20	5.0	6.0		
P	BS-t	MT20	5.0	6.0		
Q	BMWW-t	MT20	5.0	6.0		
R	BMWW-t	MT20	5.0	6.0	2.50	2.75
S	BMV-t-p	MT20	3.0	6.0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	PAGE	DIR.	TYPE	HEEL	CONN.
E	17-4-8	-110	-110	---	FRONT	VERT	TOTAL	---	C1
G	22-9-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	28-10-8	-411	-411	---	FRONT	VERT	TOTAL	---	C1
L	28-9-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
N	22-9-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
N	20-9-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
O	17-4-8	-28	-28	---	FRONT	VERT	TOTAL	---	C1
P	13-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
Q	11-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	18-9-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	20-9-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	24-9-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	28-9-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	1-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AC	3-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AD	7-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AE	9-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AF	15-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AG	18-9-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AH	24-9-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AI	28-9-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AJ	30-9-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AK	32-9-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


- 1) C1: A SUITABLE HANGER MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007956 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408314	T61	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 08:32:19 2020 Page 1	

ID:85GeBk99WNGszVGuuF_Z1BzizB3-Z8k1QhE1GE77ng2p0yd7owqaKd3F_D73PFaYOPzLbWh
 1-3-8 0-0 1-3-8 4-0-8 4-0-8 3-10-0 7-10-8 6-4-7 14-2-15 6-3-3 20-6-1 6-4-7 28-10-8 3-10-0 30-4-8 4-0-8 1-3-8
 Scale = 1:57.0

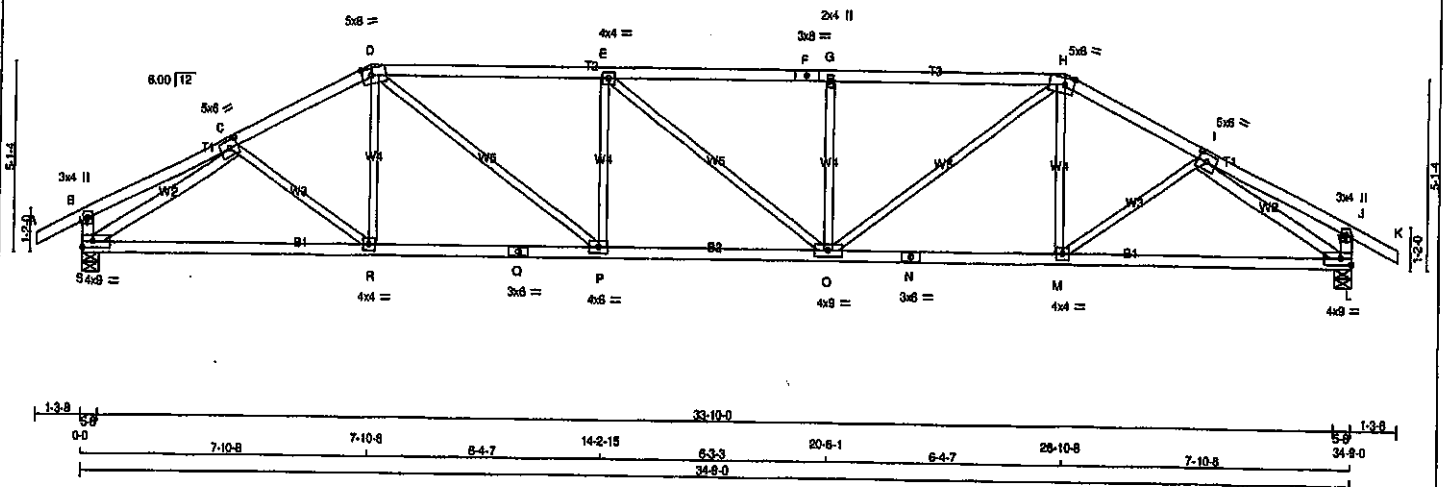

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
O - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-i	MT20	5.0	8.0	2.50	2.75
D	TTWV-m	MT20	5.0	8.0	2.25	3.00
E	TMVW-i	MT20	4.0	4.0		
F	TS-i	MT20	3.0	8.0		
G	TMV+w	MT20	2.0	4.0		
H	TTWV-m	MT20	5.0	8.0	2.25	3.00
I	TMVW-i	MT20	5.0	8.0	2.50	2.75
J	TMV+p	MT20	3.0	4.0		
L	BMVW-i	MT20	4.0	9.0		Edge
M	BMVW-i	MT20	4.0	4.0		
N	BS-i	MT20	3.0	6.0		
O	BMVW-i	MT20	4.0	9.0		
P	BMVW-i	MT20	4.0	9.0		
Q	BS-i	MT20	3.0	6.0		
R	BMVW-i	MT20	4.0	4.0		
S	BMVW-i	MT20	4.0	9.0		Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORZ	BRG	BRG	IN-SX	IN-SX
S	2040	0	2040	0	0	5-8	5-8		
L	2040	0	2040	0	0	5-8	5-8		

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1440	958 / 0	0 / 0	0 / 0	0 / 0	482 / 0	0 / 0
L	1440	958 / 0	0 / 0	0 / 0	0 / 0	482 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.03 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	C-R	0 / 91	0.03 (4)
B-C	0 / 16	-91.8	-91.8 0.20 (1)	10.00	R-D	0 / 121	0.04 (4)
C-D	-2757 / 0	-91.8	-91.8 0.31 (1)	3.91	D-P	0 / 1222	0.27 (1)
D-E	-3428 / 0	-91.8	-91.8 0.88 (1)	3.03	P-E	-829 / 0	0.24 (1)
E-F	-3425 / 0	-91.8	-91.8 0.87 (1)	3.03	E-O	-2 / 0	0.00 (1)
F-G	-3425 / 0	-91.8	-91.8 0.87 (1)	3.03	O-G	-829 / 0	0.24 (1)
G-H	-3425 / 0	-91.8	-91.8 0.87 (1)	3.04	O-H	0 / 1220	0.27 (1)
H-I	-2757 / 0	-91.8	-91.8 0.31 (1)	3.91	M-I	0 / 122	0.04 (4)
I-J	0 / 16	-91.8	-91.8 0.20 (1)	10.00	M-I	0 / 91	0.03 (4)
J-K	0 / 28	-91.8	-91.8 0.12 (1)	10.00	S-C	-2934 / 0	0.82 (1)
S-B	-270 / 0	0.0	0.0 0.03 (1)	7.81	I-L	-2934 / 0	0.82 (1)
L-J	-270 / 0	0.0	0.0 0.03 (1)	7.81			
S-R	0 / 2385	-18.5	-18.5 0.52 (1)	10.00			
R-Q	0 / 2451	-18.5	-18.5 0.53 (1)	10.00			
Q-P	0 / 2451	-18.5	-18.5 0.53 (1)	10.00			
P-O	0 / 3428	-18.5	-18.5 0.83 (1)	10.00			
O-N	0 / 2451	-18.5	-18.5 0.53 (1)	10.00			
N-M	0 / 2451	-18.5	-18.5 0.53 (1)	10.00			
M-L	0 / 2385	-18.5	-18.5 0.52 (1)	10.00			

TOTAL WEIGHT = 138 lb

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.8 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2018
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.16")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.20")
 ALLOWABLE DEFL.(TL) = L/360 (1.16")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.38")

CSI: TC=0.88/1.00 (D-E:1), BC=0.83/1.00 (O-P:1),
 WB=0.82/1.00 (H-L:1), SS=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1687 788	1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (D) (INPUT = 0.90)
 JSI METAL = 0.76 (N) (INPUT = 1.00)




Structural component only
 DWG# T-2007957

JOB NAME 408314	TRUSS NAME T62	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 08:32:20 2020 Page 1

ID:55G6Bk99WNGszVGuuF_Z1BzizB3-VWenrMGHnNrt_CC7NfbtLwUQmkSBOMsZ7UIzLbWl
13-8 0-0 5-0-8 5-0-8 4-10-0 9-10-8 7-8-0 17-4-8 7-8-0 24-10-8 4-10-0 28-8-8 5-0-8 13-8
1-3-8 34-9-0 36-0-8
Scale = 1:57.0

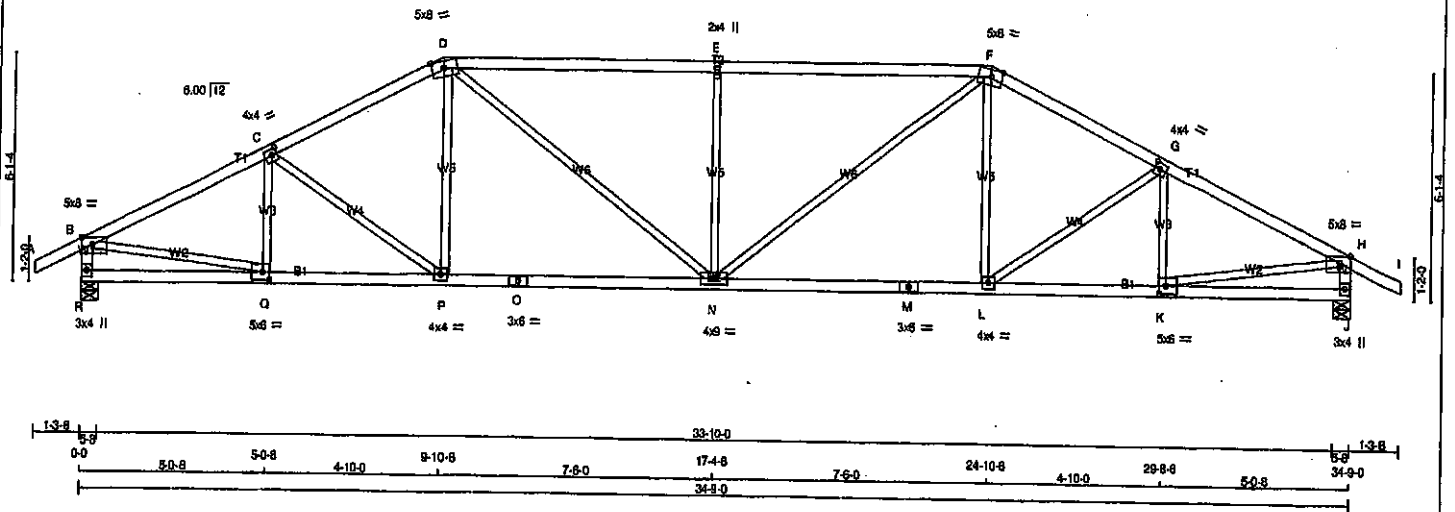

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TMVW-l	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	8.0	2.25	3.75
E	TMVW-p	MT20	2.0	4.0		
F	TMVW-m	MT20	5.0	8.0	2.25	3.75
G	TMVW-l	MT20	4.0	4.0	2.00	1.75
H	TMVW-p	MT20	5.0	8.0	Edge	3.50
I	BMV1-p	MT20	3.0	4.0		
J	BMVW-l	MT20	5.0	8.0	2.50	2.25
K	BMVW-l	MT20	4.0	4.0		
L	BS-l	MT20	3.0	8.0		
M	BMVW-l	MT20	4.0	9.0		
N	BS-l	MT20	3.0	8.0		
O	BS-l	MT20	3.0	8.0		
P	BMVW-l	MT20	4.0	4.0		
Q	BMVW-l	MT20	5.0	8.0	2.50	2.25
R	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	HORZ	GROSS REACTION	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
R	2040	0	2040	0	0	5-8	5-8	5-8	5-8
J	2040	0	2040	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST LCASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
R	1440	958 / 0	0 / 0	0 / 0	482 / 0
J	1440	958 / 0	0 / 0	0 / 0	482 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	Q-C	-348 / 0	0.08 (1)
B-C	-2796 / 0	-91.8	-91.8 0.39 (1)	3.83	C-P	-217 / 0	0.13 (1)
C-D	-2643 / 0	-91.8	-91.8 0.37 (1)	3.94	P-D	0 / 247	0.08 (4)
D-E	-2884 / 0	-91.8	-91.8 0.90 (1)	2.97	D-N	0 / 808	0.18 (1)
E-F	-2884 / 0	-91.8	-91.8 0.90 (1)	2.97	N-E	-848 / 0	0.50 (1)
F-G	-2643 / 0	-91.8	-91.8 0.37 (1)	3.94	N-F	0 / 808	0.18 (1)
G-H	-2796 / 0	-91.8	-91.8 0.39 (1)	3.83	L-F	0 / 247	0.08 (4)
H-I	0 / 28	-91.8	-91.8 0.12 (1)	10.00	L-G	-217 / 0	0.13 (1)
I-B	-1995 / 0	0.0	0.0 0.20 (1)	5.97	K-G	-348 / 0	0.08 (1)
J-H	-1995 / 0	0.0	0.0 0.20 (1)	5.97	B-Q	0 / 2557	0.58 (1)
					K-H	0 / 2557	0.58 (1)
R-Q	0 / 0	-18.5	-18.5 0.10 (4)	10.00			
Q-P	0 / 2521	-18.5	-18.5 0.50 (1)	10.00			
P-O	0 / 2348	-18.5	-18.5 0.48 (1)	10.00			
O-N	0 / 2348	-18.5	-18.5 0.48 (1)	10.00			
N-M	0 / 2348	-18.5	-18.5 0.48 (1)	10.00			
M-L	0 / 2348	-18.5	-18.5 0.48 (1)	10.00			
L-K	0 / 2521	-18.5	-18.5 0.50 (1)	10.00			
K-J	0 / 0	-18.5	-18.5 0.10 (4)	10.00			

TOTAL WEIGHT = 137 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
PART 9 OF NBC 2018, OBC 2012, ABC 2019
PART 9 OF OBC 2012 (2019 AMENDMENT)
CSA 086-09, CSA 086-14
TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.18")
CALCULATED VERT. DEFL.(LL) = L/999 (0.17")
ALLOWABLE DEFL.(TL) = L/360 (1.18")
CALCULATED VERT. DEFL.(TL) = L/999 (0.32")

CS1: TC=0.90/1.00 (E-F:1), BC=0.50/1.00 (P-Q:1), WB=0.58/1.00 (B-C:1), SS=0.33/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	
MAX MIN	MAX MIN	MAX MIN	
MT20	818	354	1687 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (K) (INPUT = 0.90)
JSI METAL = 0.74 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007958

JOB NAME 408314	TRUSS NAME T64	QUANTITY 1	PLY 3	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:32:23 2020 Page 1	
ID: 65G6Bk99WNGszVGuuf_Z1BzB3-Rv_YG2HYKSdZGIMbFol3zm_PVEOGw3N8KtZAZLbWd				34-90 38-08 1-3-8	
Scale = 1:57.0					

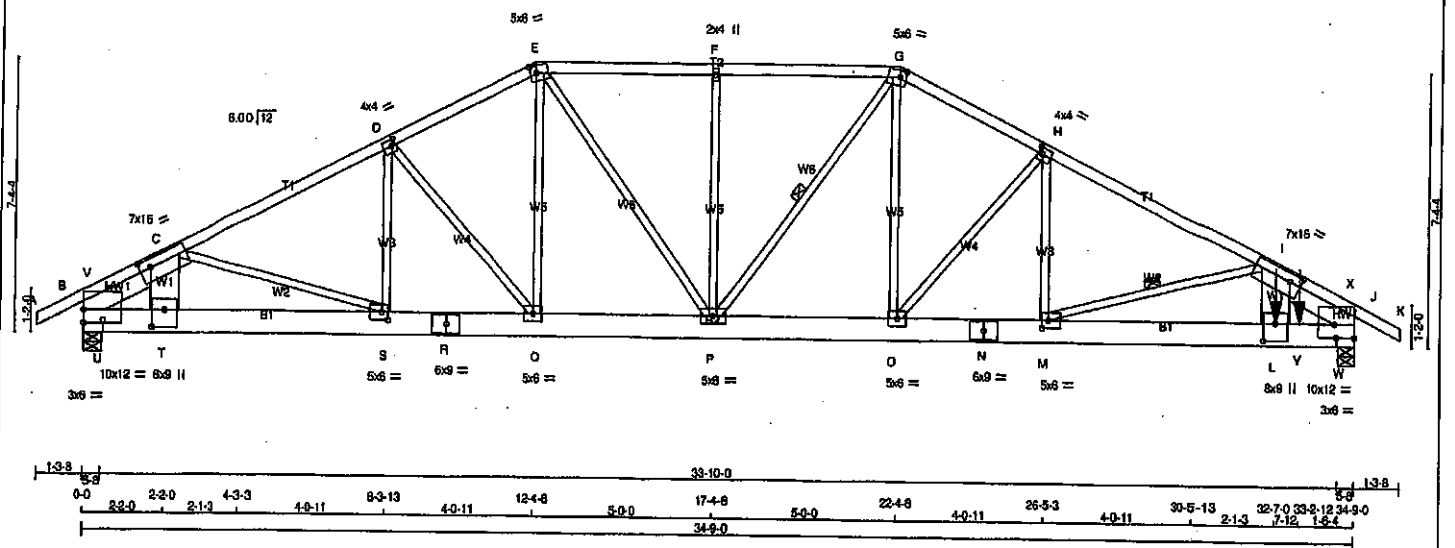

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				TOTAL WEIGHT = 3 X 201 = 602 lb			
N. L. G. A. RULES				BEARINGS				DESIGN CRITERIA			
CHORDS	SIZE	LUMBER	DESCR.	FACTORED	MAXIMUM FACTORED	INPUT	RECORD	SPECIFIED LOADS:			
A - E	2x4	DRY	No.2	SPF	GROSS REACTION	GROSS REACTION	BRG	TOP CH. LL	= 25.6 PSF		
E - G	2x4	DRY	No.2	SPF	VERT	HORZ	UPLIFT	DL	= 6.0 PSF		
G - K	2x4	DRY	No.2	SPF	JT	B	2684	BOT CH. LL	= 0.0 PSF		
B - R	2x8	DRY	No.2	SPF	J	12053	0	DL	= 7.4 PSF		
R - N	2x8	DRY	No.2	SPF				TOTAL LOAD	= 39.0 PSF		
N - J	2x8	DRY	No.2	SPF							

REINFORCING MEMBERS				UNFACTORED REACTIONS				SPACING = 24.0 IN. C.C.			
MEMB.	SIZE	LUMBER	DESCR.	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	DEAD	SOIL	LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12			
HW1	2x8	DRY	No.2	JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
HW2	2x8	DRY	No.2	B	1885	1261 / 0	0 / 0	0 / 0	634 / 0	0 / 0	0 / 0
				J	8510	5685 / 0	0 / 0	0 / 0	2845 / 0	0 / 0	0 / 0

DRY, SEASONED LUMBER.

DESIGN CONSISTS OF 3 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS SURFACE SPACING (IN) LOAD (PLF)

TOP CHORDS : (0.122"x3") SPIRAL NAILS

A-E 1 12 TOP

E-G 1 12 TOP

G-K 1 12 TOP

BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS

B-R 4 4 TOP

R-N 2 12 TOP

N-J 4 4 SIDE (2105.9)

WEBS : (0.122"x3") SPIRAL NAILS

2x6 1 8 SIDE (509.0)

2x8 2 8

L-I 5 4

2x10 5 4

STAGGER NAILS BY HALF THE SURFACE SPACING IN ADJACENT PLIES.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)	
FR-TO		FROM TO	LENGTH FR-TO	FR-TO			
A-B	-170	-91.8 -91.8 0.04 (1)	10.00	C-S	0 / 582	0.04 (1)	
B-V	-1799 / 0	-91.8 -91.8 0.01 (1)	6.25	S-D	-115 / 40	0.01 (1)	
V-C	-803 / 0	-91.8 -91.8 0.10 (1)	6.25	D-Q	-390 / 0	0.09 (1)	
C-D	-4049 / 0	-91.8 -91.8 0.17 (1)	5.44	Q-E	0 / 429	0.03 (1)	
D-E	-3798 / 0	-91.8 -91.8 0.14 (1)	5.58	E-P	0 / 1178	0.09 (1)	
E-F	-4088 / 0	-91.8 -91.8 0.15 (1)	5.42	P-F	-551 / 0	0.16 (1)	
F-G	-4088 / 0	-91.8 -91.8 0.15 (1)	5.42	P-G	-378 / 0	0.06 (1)	
G-H	-4799 / 0	-91.8 -91.8 0.19 (1)	5.04	O-G	0 / 2153	0.18 (1)	
H-I	-6833 / 0	-91.8 -91.8 0.23 (1)	4.35	O-H	-2889 / 0	0.87 (1)	
I-X	-4581 / 0	-91.8 -91.8 0.14 (1)	5.18	M-H	0 / 2523	0.19 (1)	
X-J	-9111 / 0	-91.8 -91.8 0.21 (1)	3.83	M-I	-6846 / 0	0.82 (1)	
J-K	-170	-91.8 -91.8 0.04 (1)	10.00	T-C	0 / 275	0.01 (1)	

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)	
B-U	0 / 761	-18.5 -18.5 0.08 (1)	10.00	U-V	0 / 1254	0.00 (1)	
U-T	0 / 3096	-18.5 -18.5 0.16 (1)	10.00	U-C	-3299 / 0	0.09 (1)	
T-S	0 / 3085	-18.5 -18.5 0.12 (1)	10.00	I-W	-12808 / 0	0.36 (1)	
S-R	0 / 3823	-18.5 -18.5 0.13 (1)	10.00	W-X	0 / 5911	0.00 (1)	
R-Q	0 / 3823	-18.5 -18.5 0.13 (1)	10.00				
Q-P	0 / 3376	-18.5 -18.5 0.12 (1)	10.00				
P-O	0 / 4280	-18.5 -18.5 0.15 (1)	10.00				
O-N	0 / 8135	-18.5 -18.5 0.25 (1)	10.00				
N-M	0 / 8135	-18.5 -18.5 0.25 (1)	10.00				
M-L	0 / 12684	-18.5 -18.5 0.68 (1)	10.00				
L-Y	0 / 13080	-18.5 -18.5 0.75 (1)	10.00				
Y-W	0 / 13080	-18.5 -18.5 0.75 (1)	10.00				
W-J	0 / 4015	-18.5 -18.5 0.36 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)				CONNECTION REQUIREMENTS			
JT	LOC.	LC1	MAX. MAX.	FACE	DIR.	HEEL	CONN.
L	32-7-0	-9536	-9536	---	BACK VERT	---	C1
Y	33-2-12	-1121	-1121	---	BACK VERT	---	C1

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408314	T64	1	3	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMBMW1-I	MT20	10.0	12.0	4.25	
B	TP-I	MT20	3.0	6.0	3.25	6.00
C	TMWW-I	MT20	7.0	18.0	2.75	3.50
D	TMWW-I	MT20	4.0	4.0	2.00	1.25
E	TTWW-m	MT20	5.0	6.0	2.25	2.00
F	TMW-w	MT20	2.0	4.0		
G	TTWW-m	MT20	5.0	6.0	2.25	2.00
H	TMWW-I	MT20	4.0	4.0	2.00	1.25
I	TMWWW-I	MT20	7.0	18.0	2.75	3.50
J	TMBMW1-I	MT20	10.0	12.0	4.25	Edge
J	TP-I	MT20	3.0	6.0	4.25	0.50
L	BMW-w	MT20	8.0	9.0	5.50	4.00
M	BMWW-I	MT20	5.0	6.0	2.50	2.00
N	BS-I	MT20	6.0	9.0		
O	BMWW-I	MT20	5.0	6.0		
P	BMWWW-I	MT20	5.0	6.0		
Q	BMWW-I	MT20	5.0	6.0		
R	BS-I	MT20	6.0	9.0		
S	BMWW-I	MT20	5.0	6.0	2.50	2.00
T	BMW-w	MT20	8.0	9.0	5.50	4.00

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2007960 *2/2*

Scale = 1:52.1

P-O	0/0	-18.5	-18.5	0.23 (4)	10.00
O-N	0/2391	-18.5	-18.5	0.50 (1)	10.00
N-M	0/2391	-18.5	-18.5	0.50 (1)	10.00
M-L	0/1787	-18.5	-18.5	0.38 (1)	10.00
L-K	0/1791	-18.5	-18.5	0.38 (1)	10.00
K-J	0/1791	-18.5	-18.5	0.38 (1)	10.00
J-I	0/0	-18.5	-18.5	0.16 (4)	10.00




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408314	T66	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 08:32:25 2020 Page 1

ID:85G6Bk98WNGszVGuuF_Z1BzIzB3-sUfGu4KQdN08759wwFmaPcl8RU57SG50rQ8WzLbWa

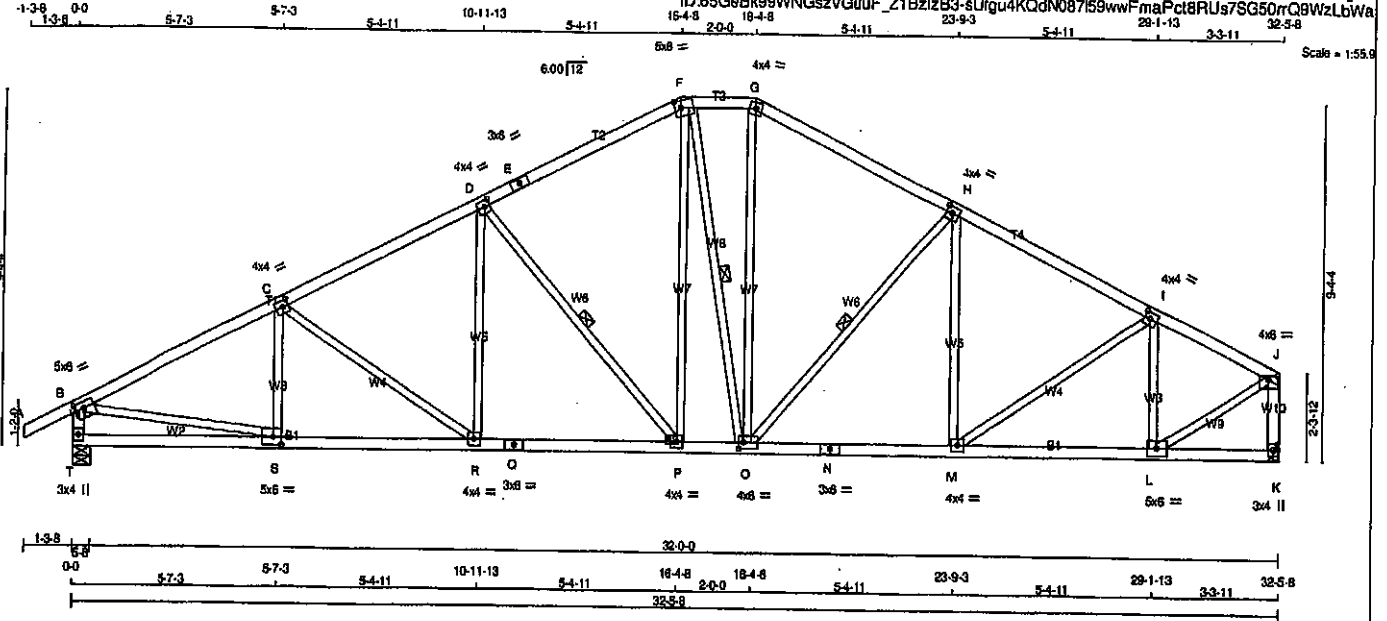

LUMBER				N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER	DESCR.	SPF	FACTORED	MAXIMUM FACTORED
A - E	2x4	DRY	No.2	SPF	JT	1914	0
E - F	2x4	DRY	No.2	SPF	T	1789	0
F - G	2x4	DRY	No.2	SPF	K	1789	0
G - J	2x4	DRY	No.2	SPF			
T - B	2x4	DRY	No.2	SPF			
K - J	2x4	DRY	No.2	SPF			
T - Q	2x4	DRY	No.2	SPF			
Q - N	2x4	DRY	No.2	SPF			
N - K	2x4	DRY	No.2	SPF			
ALL WEBS	2x3	DRY	No.2	SPF			
EXCEPT							
DRY: SEASONED LUMBER.							

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	5.0	8.0	2.00 2.75
C, D, H, I					
C	TMVW-1	MT20	4.0	4.0	2.00 1.75
E	TB-1	MT20	3.0	8.0	
F	TTWW-m	MT20	5.0	6.0	2.25 2.00
G	TTW-m	MT20	4.0	4.0	
J	TMVW-p	MT20	4.0	8.0	1.25 3.00
K	BMV1-p	MT20	3.0	4.0	
L	BMVW-1	MT20	5.0	8.0	
M, P, R					
M	BMVW-1	MT20	4.0	4.0	
N	BS-1	MT20	3.0	8.0	
O	BMVW-1	MT20	4.0	6.0	2.00 1.50
Q	BS-1	MT20	3.0	8.0	
S	BMVW-1	MT20	5.0	6.0	2.50 2.50
T	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG	BRG	BRG
T	1914	0	1914	0	5-8	5-8	5-8
K	1789	0	1789	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT K. MINIMUM BEARING LENGTH AT JOINT K = 3-8.

UNFACTORED REACTIONS		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE
T	1351	900 / 0	0 / 0
K	1265	830 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.89 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-P, F-Q, H-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	FORCE (LBS)
FR-TO		FROM TO		FR-TO	
A-B	0 / 28	-91.8 -91.8 0.12 (1)	10.00	S-C	-254 / 3
B-C	-2602 / 0	-91.8 -91.8 0.48 (1)	3.89	C-R	-303 / 0
C-D	-2342 / 0	-91.8 -91.8 0.37 (1)	4.18	R-D	0 / 278
D-E	-1809 / 0	-91.8 -91.8 0.38 (1)	4.82	D-P	-759 / 0
E-F	-1809 / 0	-91.8 -91.8 0.38 (1)	4.82	P-F	0 / 619
F-G	-1593 / 0	-91.8 -91.8 0.07 (1)	5.20	F-Q	-110 / 0
G-H	-1788 / 0	-91.8 -91.8 0.38 (1)	4.84	Q-G	0 / 505
H-I	-2051 / 0	-91.8 -91.8 0.37 (1)	4.38	O-H	-408 / 0
I-J	-1658 / 0	-91.8 -91.8 0.19 (1)	4.97	M-H	-132 / 40
T-B	-1658 / 0	0.0 0.0 0.19 (1)	8.13	M-I	0 / 414
K-J	-1767 / 0	0.0 0.0 0.22 (1)	8.28	L-I	-824 / 0
				B-S	0 / 2373
T-S	0 / 0	-18.5 -18.5 0.12 (4)	10.00	L-J	0 / 1758
S-R	0 / 2348	-18.5 -18.5 0.44 (1)	10.00		
R-Q	0 / 2095	-18.5 -18.5 0.40 (1)	10.00		
Q-P	0 / 2095	-18.5 -18.5 0.40 (1)	10.00		
P-O	0 / 1805	-18.5 -18.5 0.35 (1)	10.00		
O-N	0 / 1844	-18.5 -18.5 0.35 (1)	10.00		
N-M	0 / 1844	-18.5 -18.5 0.35 (1)	10.00		
M-L	0 / 1502	-18.5 -18.5 0.29 (1)	10.00		
L-K	0 / 0	-18.5 -18.5 0.08 (4)	10.00		

TOTAL WEIGHT = 2 X 150 = 301 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.08")
CALCULATED VERT. DEFL.(TL) = L/999 (0.21")

CSI: TC=0.48/1.00 (B-C:1), BC=0.44/1.00 (R-S:1),

WB=0.53/1.00 (B-S:1), SS=0.21/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (B) (INPUT = 0.90)


JSI METAL= 0.69 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007982

JOB NAME 408314	TRUSS NAME T67	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:32:26 2020 Page 1
ID:85G6Bk99WNGszVGuuF_Z1BzizB3-KgD28QK2Oh8?mUdm77c9xCrsvPEFVazlyzLbWZ

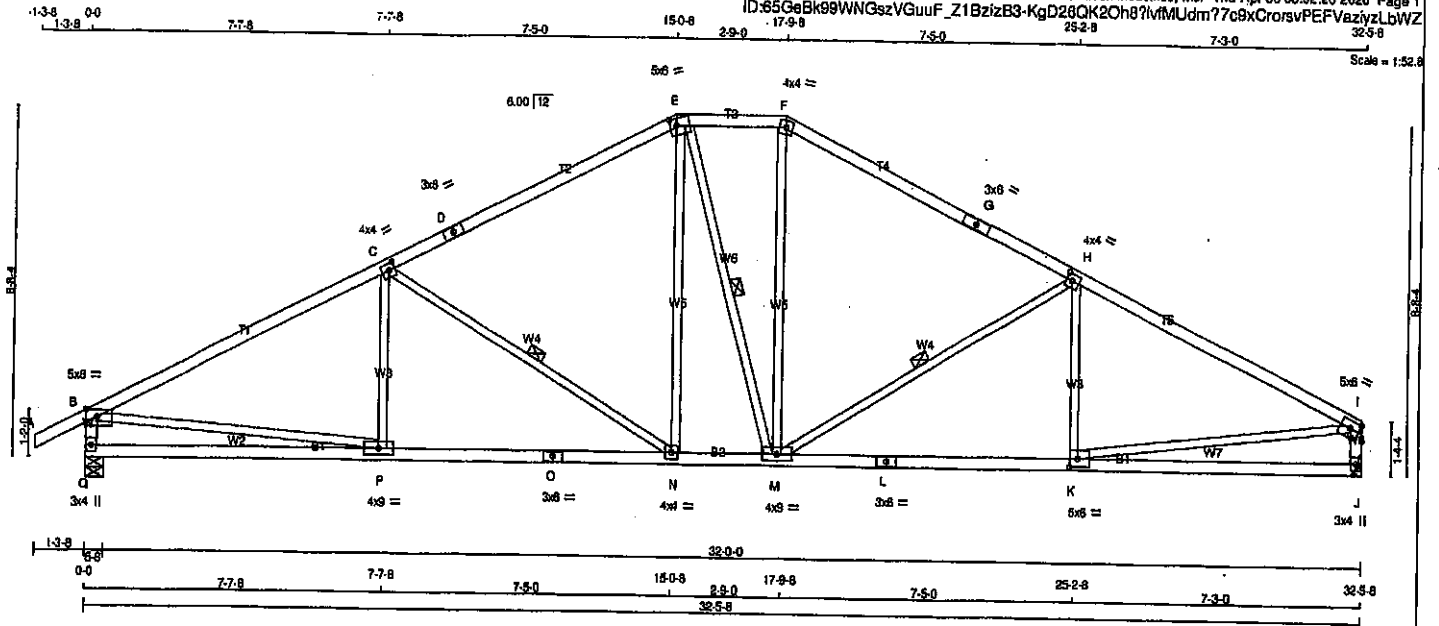

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
J - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	X
B	TMWV-p	MT20	5.0	8.0	Edge 3.50
C	TMWV-l	MT20	4.0	4.0	2.00 1.75
D	TS-l	MT20	3.0	8.0	
E	TTWV-m	MT20	5.0	6.0	2.25 2.00
F	TTW-m	MT20	4.0	4.0	
G	TS-l	MT20	3.0	8.0	
H	TMWV-l	MT20	4.0	4.0	2.00 1.75
I	TMWV-l	MT20	5.0	8.0	2.25 Edge
J	BMV-l-p	MT20	3.0	4.0	
K	BMWV-l	MT20	5.0	6.0	2.50 2.50
L	BS-l	MT20	3.0	6.0	
M	BMWVW-l	MT20	4.0	9.0	
N	BMWV-l	MT20	4.0	4.0	
O	BS-l	MT20	3.0	6.0	
P	BMWV-l	MT20	4.0	9.0	
Q	BMV-l-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		RECORD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
Q	1914	0	1914	0	0	5-8	5-8
J	1789	0	1789	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
Q	1351	900 / 0	0 / 0	0 / 0	0 / 0	451 / 0	0 / 0
J	1265	830 / 0	0 / 0	0 / 0	0 / 0	435 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.15 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, E-M, H-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0 / 28	P-C	-110 / 92
B-C	-2635 / 0	C-N	-787 / 0
C-D	-1984 / 0	N-E	0 / 496
D-E	-1984 / 0	E-M	-16 / 0
E-F	-1723 / 0	M-F	0 / 475
F-G	-1957 / 0	M-H	-680 / 0
G-H	-1957 / 0	H-K	-180 / 83
H-I	-2539 / 0	K-L	0 / 2405
I-J	-1856 / 0	L-K	0 / 2328
J-I	-1734 / 0		
Q-P	0 / 0		
P-O	0 / 2390		
O-N	0 / 2390		
N-M	0 / 1728		
M-L	0 / 2304		
L-K	0 / 2304		
K-J	0 / 0		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD =	39.0	PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLES WITH:
- PART 9 OF NBCC 2010, NBCC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")
CALCULATED VERT. DEFL.(LL) = U/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.08")
CALCULATED VERT. DEFL.(TL) = U/999 (0.26")

CSI: TC=0.95/1.00 (B-C:1), BC=0.52/1.00 (N-P:1), WB=0.54/1.00 (B-P:1), SS=0.39/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	818	354	1687
	788	1687	1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.80 (I) (INPUT = 0.90)
JSI METAL = 0.83 (O) (INPUT = 1.00)



Structural component only
DWG# T-2007963

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408314	T68	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

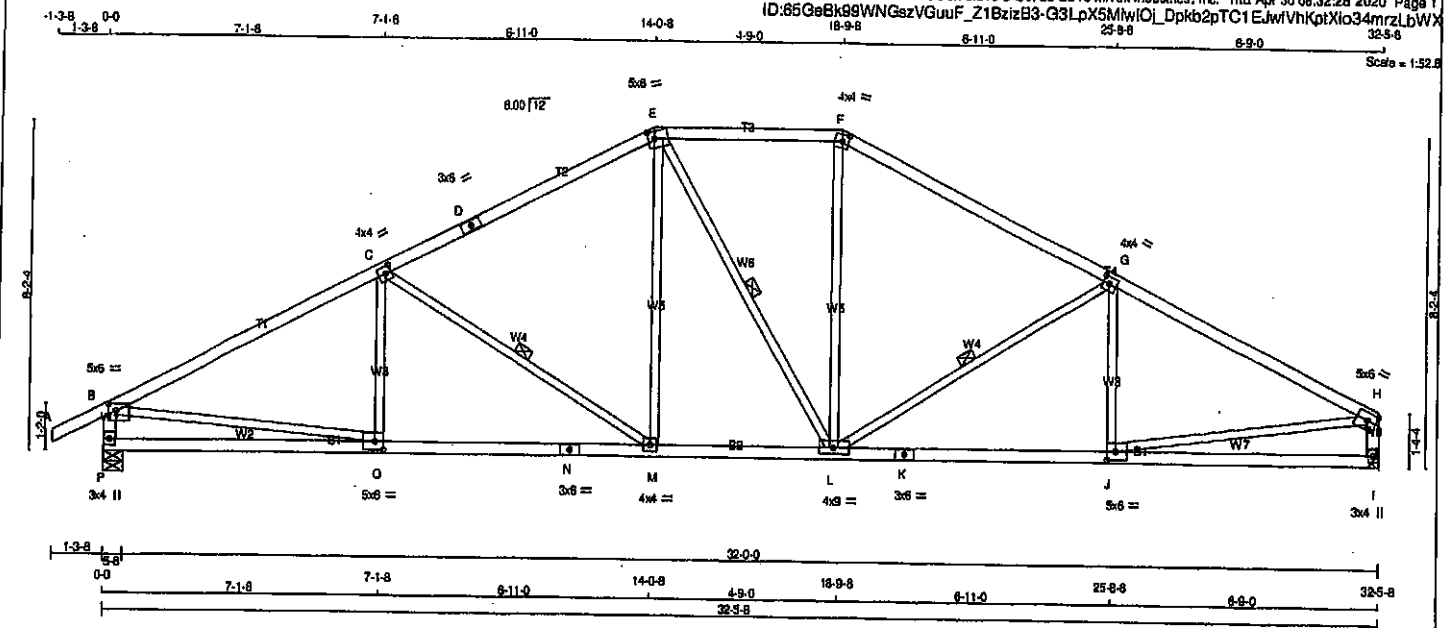

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
P - O	2x4	DRY	No.2
O - N	2x4	DRY	No.2
N - M	2x4	DRY	No.2
M - L	2x4	DRY	No.2
L - K	2x4	DRY	No.2
K - J	2x4	DRY	No.2
J - I	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF

DRY: SEASONED LUMBER.

PLATES (Table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMWV-p	MT20	5.0	6.0 2.00 2.25
C	TMWV-t	MT20	4.0	4.0 2.00 1.75
D	TS-t	MT20	3.0	6.0
E	TTWV-m	MT20	5.0	6.0 2.25 2.00
F	TTW-m	MT20	4.0	4.0 2.00 1.75
G	TMWV-t	MT20	4.0	4.0 2.00 1.75
H	TMWV-t	MT20	5.0	6.0 2.25 Edge
I	BMV1-p	MT20	3.0	4.0
J	BMWV-t	MT20	5.0	6.0 2.50 2.50
K	BS-t	MT20	3.0	6.0
L	BMWV-t	MT20	4.0	9.0
M	BMWV-t	MT20	4.0	4.0
N	BS-t	MT20	3.0	6.0
O	BMWV-t	MT20	5.0	6.0 2.50 2.50
P	BMV1-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT REORD BRG
P	1914 0	1914 0	5-8
I	1789 0	1789 0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS						
JT	1ST CASE COMBINED	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND
P	1351	900 / 0	0 / 0	0 / 0	0 / 0	451 / 0
I	1285	830 / 0	0 / 0	0 / 0	0 / 0	435 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.39 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-M, E-L, G-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
A-B	0 / 28	-91.8	10.00
B-C	-2840 / 0	-91.8	10.00
C-D	-2057 / 0	-91.8	10.00
D-E	-2057 / 0	-91.8	10.00
E-F	-1803 / 0	-91.8	10.00
F-G	-2043 / 0	-91.8	10.00
G-H	-2534 / 0	-91.8	10.00
H-I	-1859 / 0	-91.8	10.00
I-J	-1738 / 0	-91.8	10.00
J-K	0 / 0	-91.8	10.00
K-L	0 / 0	-91.8	10.00
L-M	0 / 0	-91.8	10.00
M-N	0 / 0	-91.8	10.00
N-O	0 / 0	-91.8	10.00
O-P	0 / 0	-91.8	10.00

WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)
O-C	-141 / 72	10.00	0.05 (1)
C-M	-691 / 0	10.00	0.32 (1)
M-E	0 / 489	10.00	0.11 (1)
E-L	-22 / 0	10.00	0.01 (1)
L-F	0 / 440	10.00	0.10 (1)
F-G	-591 / 0	10.00	0.28 (1)
G-J	-215 / 43	10.00	0.07 (1)
J-O	0 / 2409	10.00	0.54 (1)
O-P	0 / 2324	10.00	0.52 (1)

TOTAL WEIGHT = 132 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.8 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.08')
CALCULATED VERT. DEFL. (LL) = L/899 (0.12')
ALLOWABLE DEFL. (TL) = L/360 (1.08')
CALCULATED VERT. DEFL. (TL) = L/899 (0.25')

CSI: TC=0.81/1.00 (B-C:1), BC=0.49/1.00 (M-O:1), WB=0.54/1.00 (B-O:1), SS=0.28/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1687

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.78 (N) (INPUT = 1.00)



Structural component only
DWG# T-2007964

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408314	T69	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 28 2019 MTEK Industries, Inc. Thu Apr 30 08:32:28 2020 Page 1
 ID:65GeBk99WNGszVGuuF_Z1BzizB3-kFvBkRNhcWZcMOx9mKilFNP2sc3G9gxSpdIHZLbWW
 32-5-8
 Scale = 1:52.2

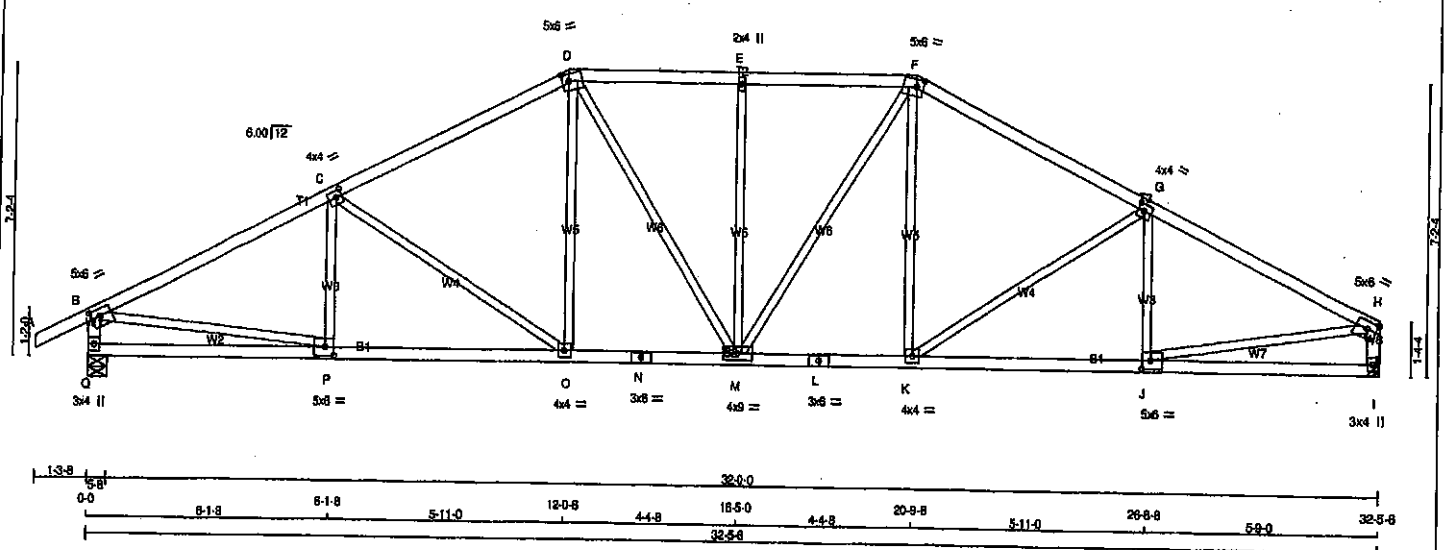

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
Q - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
L - I	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-1	MT20	5.0	6.0	2.00 2.75
C	TMVW-1	MT20	4.0	4.0	2.00 1.75
D	TTWW-m	MT20	5.0	6.0	2.25 2.00
E	TMVW-w	MT20	2.0	4.0	
F	TTWW-m	MT20	5.0	6.0	2.25 2.00
G	TMVW-1	MT20	4.0	4.0	2.00 1.75
H	TMVW-1	MT20	5.0	6.0	2.25 Edge
I	BMV1-p	MT20	3.0	4.0	
J	BMVW-1	MT20	5.0	6.0	2.50 2.50
K	BMVW-1	MT20	4.0	4.0	
L	BS-1	MT20	3.0	6.0	
M	BMVWW-1	MT20	4.0	4.0	
N	BS-1	MT20	3.0	6.0	
O	BMVW-1	MT20	4.0	4.0	
P	BMVW-1	MT20	5.0	6.0	2.50 2.50
Q	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	UP	BRG	BRG	IN-SX	IN-SX
Q	1914	0	1914	0	0	5-8	5-8		
I	1789	0	1789	0	0	MECHANICAL			

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERMILIVE	WIND
Q	1351	900/0	0/0	0/0	0/0
I	1285	830/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.73 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT.	LOAD (LBS)	LC1	MAX	MEMB.	FORCE (LBS)	MAX	CS1 (LBS)
FR-TO		FROM	TO			FR-TO			
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00	P-C	-213/30	0.06 (1)	
B-C	-2832/0	-91.8	-91.8	0.57 (1)	3.73	C-O	-490/0	0.49 (1)	
C-D	-2233/0	-91.8	-91.8	0.51 (1)	4.08	O-D	0/369	0.08 (1)	
D-E	-2136/0	-91.8	-91.8	0.27 (1)	4.41	D-M	0/301	0.07 (1)	
E-F	-2136/0	-91.8	-91.8	0.27 (1)	4.41	M-E	-488/0	0.44 (1)	
F-G	-2203/0	-91.8	-91.8	0.49 (1)	4.11	M-F	0/350	0.08 (1)	
G-H	-2503/0	-91.8	-91.8	0.51 (1)	3.88	K-F	0/312	0.07 (1)	
H-I	-1885/0	0.0	0.0	0.19 (1)	6.14	K-G	-382/0	0.38 (1)	
I-H	-1744/0	0.0	0.0	0.18 (1)	6.31	J-G	-285/0	0.08 (1)	
						B-P	0/2403	0.54 (1)	
Q-P	0/0	-18.5	-18.5	0.16 (4)	10.00	J-H	0/2301	0.52 (1)	
P-O	0/2380	-18.5	-18.5	0.45 (1)	10.00				
O-N	0/1975	-18.5	-18.5	0.38 (1)	10.00				
N-M	0/1975	-18.5	-18.5	0.38 (1)	10.00				
M-L	0/1949	-18.5	-18.5	0.37 (1)	10.00				
L-K	0/1949	-18.5	-18.5	0.37 (1)	10.00				
K-J	0/2284	-18.5	-18.5	0.43 (1)	10.00				
J-I	0/0	-18.5	-18.5	0.14 (4)	10.00				

TOTAL WEIGHT = 136 lb (MIP)

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.08")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
 ALLOWABLE DEFL.(TL) = L/360 (1.08")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CS1: TC=0.57/1.00 (B-C:1), BC=0.45/1.00 (O-P:1), WS=0.54/1.00 (B-P:1), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 768 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.90 (B) (INPUT = 0.90)
 JSI METAL = 0.70 (B) (INPUT = 1.00)

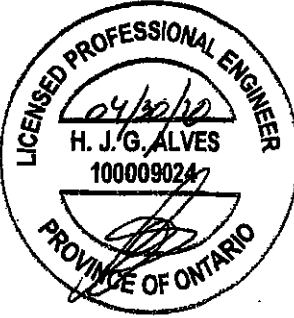

Structural component only
 DWG# T-2007965

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ORWG NO.
408314	T70	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 08:22:30 2020 Page 1

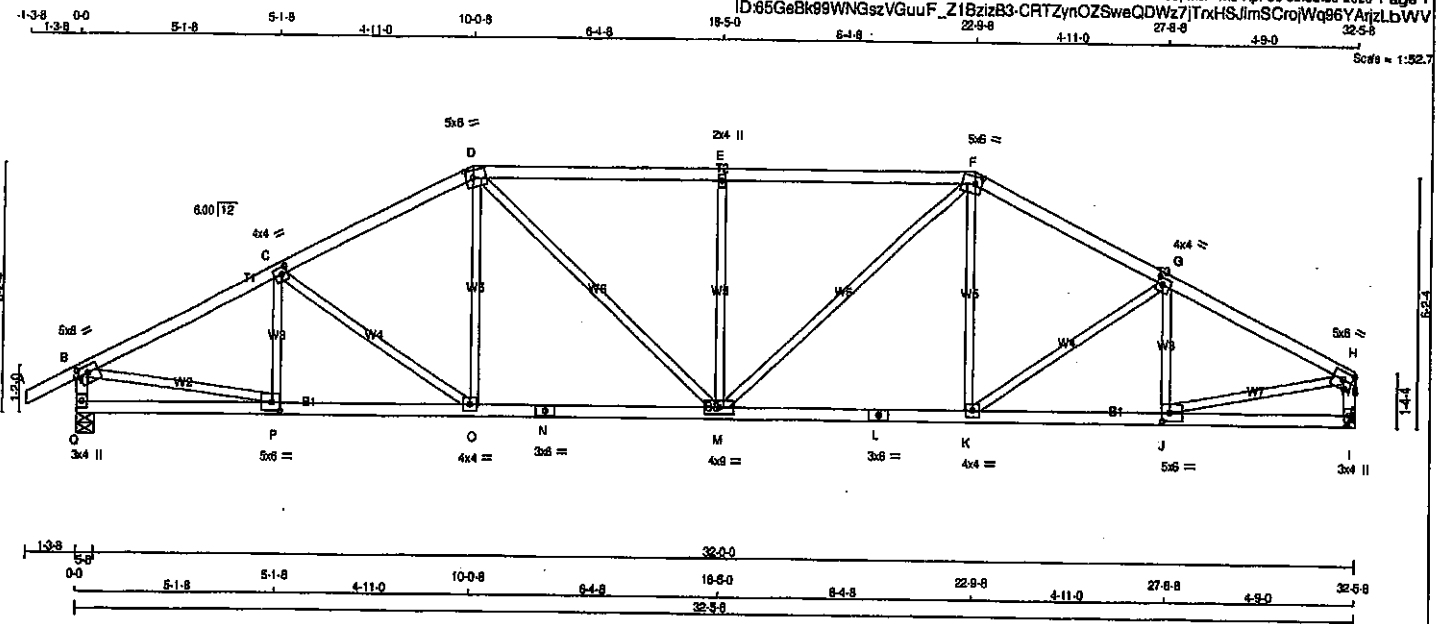

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - N	2x4	DRY	No.2
N - O	2x4	DRY	No.2
O - Q	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y
B	TMWV-1	MT20	5.0	8.0	2.00
C	TMWV-1	MT20	4.0	4.0	2.00
D	TTWV-m	MT20	5.0	8.0	2.25
E	TMWV-w	MT20	2.0	4.0	2.00
F	TTWV-m	MT20	5.0	8.0	2.25
G	TMWV-t	MT20	4.0	4.0	2.00
H	TMWV-t	MT20	5.0	8.0	2.25
I	BMV1-p	MT20	3.0	4.0	
J	BMWV-t	MT20	5.0	8.0	2.50
K	BMWV-t	MT20	4.0	4.0	
L	BS-t	MT20	3.0	8.0	
M	BMWV-w	MT20	4.0	8.0	
N	BS-t	MT20	3.0	8.0	
O	BMWV-t	MT20	4.0	4.0	
P	BMWV-t	MT20	5.0	8.0	2.50
Q	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

REARINGS					
	FACTORED	MAXIMUM FACTORED	INPUT	RECORD	
JT	GROSS REACTION	GROSS REACTION	BRG	BRG	
Q	VERT	HORZ	DOWN	UPLIFT	IN-SX
I	1914	0	1914	0	5-8
I	1789	0	1789	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3'-6".

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
Q	1351	900 / 0	0 / 0	0 / 0	0 / 0	451 / 0	0 / 0
I	1265	830 / 0	0 / 0	0 / 0	0 / 0	435 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.70 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	P-C	-301 / 0
B-C	-2599 / 0	-91.8	-91.8	0.39 (1)	3.96	C-D	-274 / 0
C-D	-2388 / 0	-91.8	-91.8	0.36 (1)	4.12	D-E	0 / 298
D-E	-2547 / 0	-91.8	-91.8	0.59 (1)	3.70	E-F	0 / 584
E-F	-2547 / 0	-91.8	-91.8	0.59 (1)	3.70	F-G	-719 / 0
F-G	-2338 / 0	-91.8	-91.8	0.34 (1)	4.11	G-H	0 / 845
G-H	-2433 / 0	-91.8	-91.8	0.34 (1)	4.11	H-I	0 / 199
H-I	-1870 / 0	0.0	0.0	0.19 (1)	6.13	I-J	-154 / 0
I-J	-1749 / 0	0.0	0.0	0.18 (1)	6.30	J-K	-397 / 0
K-L	0 / 0	-18.5	-18.5	0.10 (4)	10.00	L-M	0 / 2372
L-M	0 / 2339	-18.5	-18.5	0.45 (1)	10.00	M-N	0 / 2249
M-N	0 / 2118	-18.5	-18.5	0.41 (1)	10.00	N-O	0 / 2118
N-O	0 / 2118	-18.5	-18.5	0.41 (1)	10.00	O-P	0 / 2073
O-P	0 / 2073	-18.5	-18.5	0.40 (1)	10.00	P-Q	0 / 2073
P-Q	0 / 2073	-18.5	-18.5	0.40 (1)	10.00	Q-R	0 / 2197
Q-R	0 / 2197	-18.5	-18.5	0.42 (1)	10.00	R-S	0 / 0
R-S	0 / 0	-18.5	-18.5	0.09 (4)	10.00	S-T	0 / 0

TOTAL WEIGHT = 130 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	8.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(66 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.08")
CALCULATED VERT. DEFL. (LL) = L/999 (0.13")
ALLOWABLE DEFL. (TL) = L/360 (1.08")
CALCULATED VERT. DEFL. (TL) = L/999 (0.25")

CSI: TC=0.59/1.00 (D-E:1), BC=0.45/1.00 (O-P:1), WB=0.53/1.00 (B-P:1), SS=0.28/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 L.S. BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PL)
MT20	618	354
	1887	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (P) (INPUT = 0.90)
JSI METAL = 0.69 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007966

JOB NAME 408314	TRUSS NAME 171	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:32:31 2020 Page 1
ID:65GeBk99WNQszVGvuf_Z1BzizB3-he1x97OBODmHrgYJGBMAggs1ZsWsXA_zOmikN9zLbWU

Scale = 1:52.7

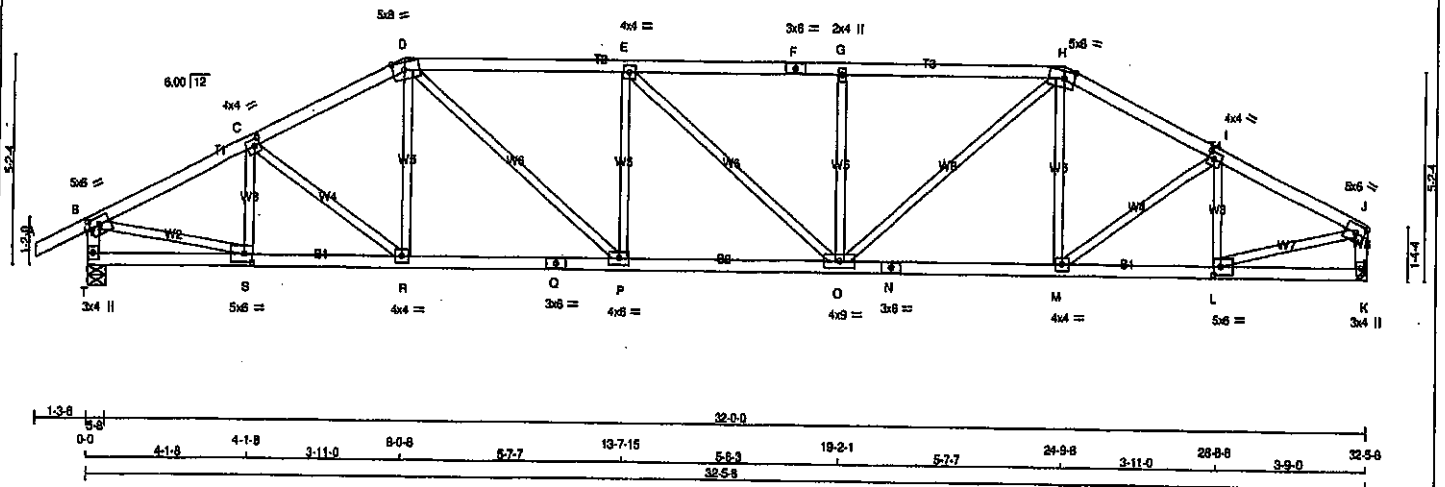

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
T - B	2x4	DRY	No.2
K - J	2x4	DRY	No.2
T - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-t	MT20	5.0	8.0 2.25 2.75
C	TMVW-t	MT20	4.0	4.0 2.00 1.75
D	TTWW-m	MT20	5.0	8.0 2.25 3.50
E	TMVW-t	MT20	4.0	4.0
F	TS-t	MT20	3.0	8.0
G	TMVW-t	MT20	2.0	4.0
H	TTWW-m	MT20	5.0	8.0 2.25 3.25
I	TMVW-t	MT20	4.0	4.0 2.00 1.75
J	TMVW-t	MT20	5.0	8.0 Edge
K	BMV1-p	MT20	3.0	4.0
L	BMVW-t	MT20	5.0	8.0 2.50 2.25
M	BMVW-t	MT20	4.0	4.0
N	BS-t	MT20	3.0	8.0
O	BMVW-t	MT20	4.0	9.0
P	BMVW-t	MT20	4.0	8.0
Q	BS-t	MT20	3.0	8.0
R	BMVW-t	MT20	4.0	4.0
S	BMVW-t	MT20	5.0	8.0 2.50 2.25
T	BMV1-p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
JT	FACTORED GROSS REACTION	VERT	HORIZ	MAXIMUM FACTORED GROSS REACTION	DOWN	UP	REARO BRG
T	1914	0	0	1914	0	0	5-8
K	1789	0	0	1789	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT K. MINIMUM BEARING LENGTH AT JOINT K = 3-8.

UNFACTORED REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM	LIVE	WIND	DEAD
T	1351	900/0	0/0	0/0	0/0	0/0	451/0
K	1265	890/0	0/0	0/0	0/0	0/0	435/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.62 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING							
TOTAL LOAD CASES: (4)							
CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0/28	-91.8 -91.8	0.12 (1)	10.00	S-C	-406/0	0.08 (1)
B-C	-2508/0	-91.8 -91.8	0.32 (1)	4.07	C-R	-48/0	0.02 (1)
C-D	-2504/0	-91.8 -91.8	0.31 (1)	4.07	R-D	0/127	0.04 (4)
D-E	-2854/0	-91.8 -91.8	0.59 (1)	3.52	D-P	0/967	0.22 (1)
E-F	-2929/0	-91.8 -91.8	0.58 (1)	3.53	P-E	-533/0	0.21 (1)
F-G	-2929/0	-91.8 -91.8	0.58 (1)	3.53	E-D	-33/0	0.04 (1)
G-H	-2929/0	-91.8 -91.8	0.58 (1)	3.55	O-G	-553/0	0.22 (1)
H-I	-2425/0	-91.8 -91.8	0.29 (1)	4.16	O-H	0/1028	0.23 (1)
I-J	-2306/0	-91.8 -91.8	0.27 (1)	4.25	M-H	0/80	0.03 (4)
T-B	-1875/0	0.0 0.0	0.19 (1)	6.13	M-I	0/90	0.02 (1)
K-J	-1754/0	0.0 0.0	0.18 (1)	6.29	L-I	-520/0	0.10 (1)
T-S	0/0	-18.5 -18.5	0.07 (4)	10.00	B-S	0/2307	0.52 (1)
S-R	0/2258	-18.5 -18.5	0.42 (1)	10.00	L-J	0/2159	0.49 (1)
R-Q	0/2224	-18.5 -18.5	0.41 (1)	10.00			
Q-P	0/2224	-18.5 -18.5	0.41 (1)	10.00			
P-O	0/2954	-18.5 -18.5	0.52 (1)	10.00			
O-N	0/2154	-18.5 -18.5	0.40 (1)	10.00			
N-M	0/2154	-18.5 -18.5	0.40 (1)	10.00			
M-L	0/2090	-18.5 -18.5	0.39 (1)	10.00			
L-K	0/0	-18.5 -18.5	0.06 (4)	10.00			

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL =	25.6 PSF
DL =	6.0 PSF
BOT CH. LL =	0.0 PSF
DL =	7.4 PSF
TOTAL LOAD =	39.0 PSF
SPACING =	24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABO 2010
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.06")
CALCULATED VERT. DEFL.(LL)= L/999 (0.16")
ALLOWABLE DEFL.(TL)= L/360 (1.06")
CALCULATED VERT. DEFL.(TL)= L/999 (0.28")

CSI: TC=0.59/1.00 (D-E:1), BC=0.52/1.00 (O-P:1),
WB=0.52/1.00 (B-S:1), SS=0.24/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1887 788

1987 1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.90 (J) (INPUT = 0.90)
JSI METAL= 0.89 (Q) (INPUT = 1.00)

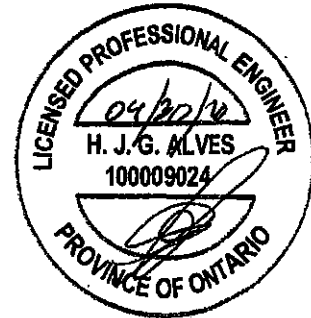

Structural component only
DWG# T-2007967

JOB NAME 408314	TRUSS NAME T72	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:32:33 2020 Page 1	

ID:85GeBk99WNGszVGuuF_Z1BzizB3-d08lapQRkU74_iObOav5xDNgCw743Gs4nrR2zLbWS
25-9-8 28-9-8 1-0-0 6-0-8 32-10-0
Scale = 1:53.4

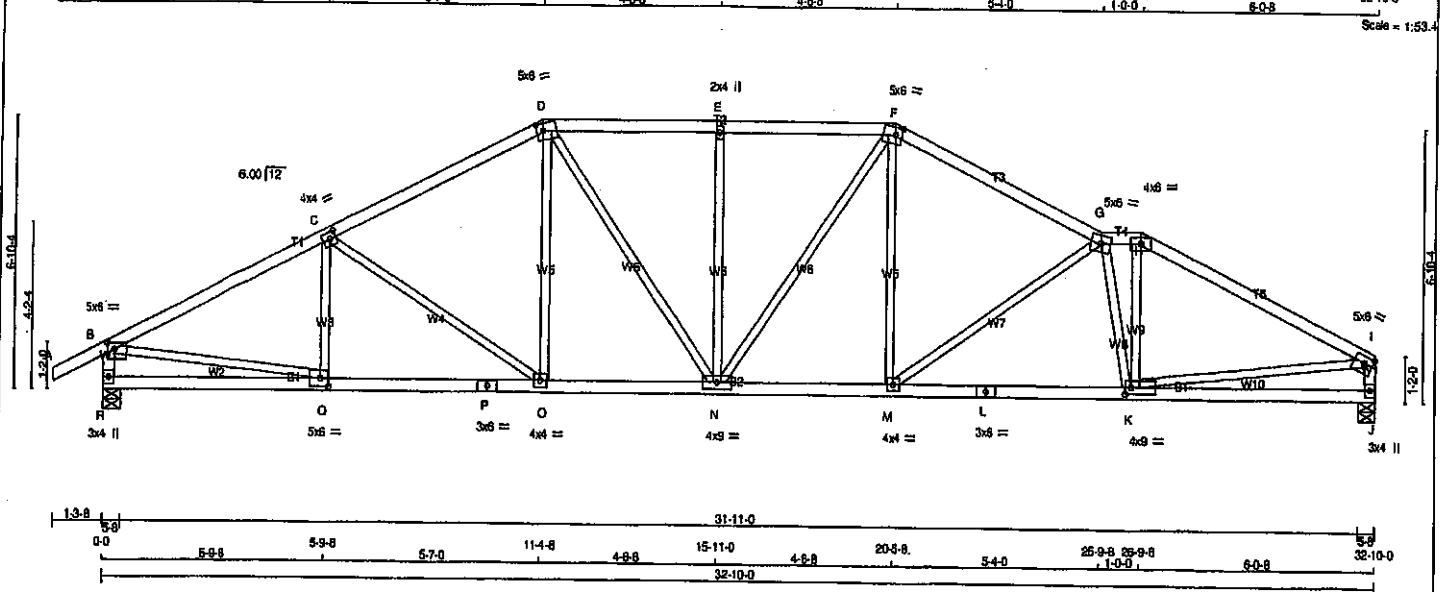

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - I	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMWV-p	MT20	5.0	8.0	2.00 2.25
C TMWV-I	MT20	4.0	4.0	2.00 1.75
D TTWV-m	MT20	5.0	8.0	2.25 2.00
E TMWV-w	MT20	2.0	4.0	
F TTWV-m	MT20	5.0	8.0	2.25 2.00
G TTWV-m	MT20	5.0	8.0	
H TTW-I	MT20	4.0	8.0	
I TMWV-I	MT20	5.0	8.0	2.00 2.75
J BMV1-p	MT20	3.0	4.0	
K BMWVW-I	MT20	4.0	9.0	2.00 1.75
L BS-I	MT20	3.0	8.0	
M BMWVW-I	MT20	4.0	9.0	
N BMWVW-I	MT20	4.0	9.0	
O BMWVW-I	MT20	4.0	9.0	
P BS-I	MT20	3.0	8.0	
Q BMWVW-I	MT20	5.0	8.0	2.50 2.50
R BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
JT	FACTORED GROSS REACTION	VERT	HORZ	MAXIMUM FACTORED GROSS REACTION	DOWN	HORZ	UPLIFT	INPUT BRG	RECORD BRG
R	1834	0	0	1834	0	0	0	5-8	5-8
J	1810	0	0	1810	0	0	0	5-8	5-8
UNFACTORED REACTIONS									
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
R	1368	909/0	0/0	0/0	0/0	468/0	0/0		
J	1280	840/0	0/0	0/0	0/0	440/0	0/0		

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS									
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX (CSI (LC))	MAX. UNBRAC LENGTH (FR-TO)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX (CSI (LC))	MAX. UNBRAC LENGTH (FR-TO)
A-B	0/28	-91.8	-91.8 0.12 (1)	10.00	C-C	-244/13	0.08 (1)		
B-C	-2659/0	-91.8	-91.8 0.51 (1)	3.79	C-D	-416/0	0.38 (1)		
C-D	-2327/0	-91.8	-91.8 0.48 (1)	4.05	D-E	0/329	0.07 (1)		
D-E	-2298/0	-91.8	-91.8 0.30 (1)	4.25	E-F	0/417	0.09 (1)		
E-F	-2298/0	-91.8	-91.8 0.30 (1)	4.25	F-G	-505/0	0.40 (1)		
F-G	-2381/0	-91.8	-91.8 0.43 (1)	4.05	G-H	0/282	0.08 (1)		
G-H	-2368/0	-91.8	-91.8 0.07 (1)	4.43	H-I	0/424	0.10 (1)		
H-I	-2698/0	-91.8	-91.8 0.57 (1)	3.74	I-J	-551/0	0.48 (1)		
I-J	-1887/0	0.0	0.0 0.19 (1)	8.11	J-K	0/843	0.19 (1)		
J-K	-1761/0	0.0	0.0 0.18 (1)	8.29	K-L	0/2428	0.55 (1)		
K-L	0/0	0.0	0.0 0.14 (4)	10.00	L-M	0/2345	0.53 (1)		
L-M	0/2402	-18.5	-18.5 0.44 (1)	10.00	M-N	-1056/0	0.29 (1)		
M-N	0/2402	-18.5	-18.5 0.44 (1)	10.00	N-O	0/2060	-18.5	-18.5 0.39 (1)	10.00
N-O	0/2060	-18.5	-18.5 0.40 (1)	10.00	O-P	0/2137	-18.5	-18.5 0.40 (1)	10.00
O-P	0/2137	-18.5	-18.5 0.40 (1)	10.00	P-Q	0/2579	-18.5	-18.5 0.49 (1)	10.00
P-Q	0/2579	-18.5	-18.5 0.49 (1)	10.00	Q-R	0/2579	-18.5	-18.5 0.49 (1)	10.00
Q-R	0/0	-18.5	-18.5 0.17 (4)	10.00	R-S	0/0	-18.5	-18.5 0.17 (4)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.8 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN ALL PLAT SECTIONS BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.09")
CALCULATED VERT. DEFL.(LL) = L/999 (0.13")
ALLOWABLE DEFL.(TL) = L/360 (1.09")
CALCULATED VERT. DEFL.(TL) = L/999 (0.25")

CSI: TC=0.57/1.00 (H-I:1), BC=0.49/1.00 (K-M:1), WB=0.55/1.00 (B-C:1), SS=0.23/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1867 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (C) (INPUT = 0.90)
JSI METAL= 0.83 (L) (INPUT = 1.00)




Structural component only
 DWG# T-2007968



JOB NAME 408314	TRUSS NAME T74	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:32:35 2020 Page 1
 ID: 85GeBk99WNGszVGuuf_Z1BzbB3-ZPGS7VRIGSGjKHr4V0R6_W1XBT1?TuXZJOGxWxzLbWQ
 29-9-8 30-9-8 32-10-0 34-1-8
 1-3-8 0-0 3-9-8 3-9-8 3-7-0 7-4-8 5-8-12 13-1-4 5-7-8 18-8-12 5-8-12 24-5-6 5-4-0 1-0-0 2-0-8 1-3-8
 Scale = 1:54.7

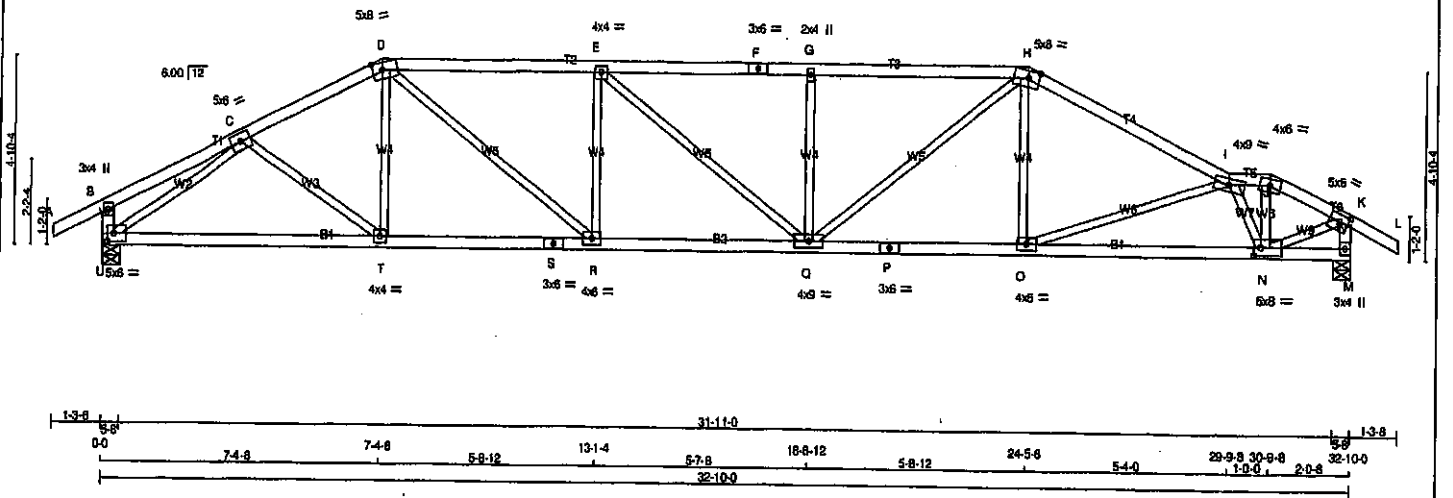

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
J - L	2x4	DRY	No.2
U - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
U - S	2x4	DRY	No.2
S - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0	
C	TMWW-I	MT20	5.0	8.0	
D	TTWW-m	MT20	5.0	8.0	2.25 3.00
E	TMWW-I	MT20	4.0	4.0	
F	TS-I	MT20	3.0	8.0	
G	TMW-w	MT20	2.0	4.0	
H	TTWW-m	MT20	5.0	8.0	2.25 3.50
I	TTWW-m	MT20	4.0	8.0	
J	TTW-m	MT20	4.0	8.0	
K	TMVW-I	MT20	5.0	8.0	2.25 2.75
M	BMV1-p	MT20	3.0	4.0	
N	BMWWW-I	MT20	5.0	8.0	2.50 2.00
O	BMWW-I	MT20	4.0	8.0	
P	BS-I	MT20	3.0	8.0	
Q	BMWWW-I	MT20	4.0	8.0	
R	BMWW-I	MT20	4.0	8.0	
S	BS-I	MT20	3.0	8.0	
T	BMWW-I	MT20	4.0	8.0	
U	BMVW1-I	MT20	5.0	8.0	2.50 2.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	DOWN	0	0
U	HORZ	UPLIFT	5-8	5-8
M	HORZ	UPLIFT	5-8	5-8

UNFACTORED REACTIONS

	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
U	1388	808 / 0 0 / 0 0 / 0 0 / 0 458 / 0 0 / 0
M	1388	808 / 0 0 / 0 0 / 0 0 / 0 458 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.31 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO	UNBRAC LENGTH	FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	C-T	0 / 105 0.03 (4)	
B-C	0 / 14	-91.8	-91.8 0.18 (1)	10.00	T-D	0 / 106 0.04 (4)	
C-D	-2578 / 0	-91.8	-91.8 0.25 (1)	4.09	D-R	0 / 1147 0.28 (1)	
D-E	-3191 / 0	-91.8	-91.8 0.65 (1)	3.35	R-E	-821 / 0 0.21 (1)	
E-F	-3259 / 0	-91.8	-91.8 0.65 (1)	3.31	E-Q	0 / 88 0.02 (1)	
F-G	-3259 / 0	-91.8	-91.8 0.65 (1)	3.31	Q-G	-564 / 0 0.20 (1)	
G-H	-3259 / 0	-91.8	-91.8 0.65 (1)	3.32	Q-H	0 / 978 0.22 (1)	
H-I	-2785 / 0	-91.8	-91.8 0.65 (1)	3.50	O-H	0 / 174 0.05 (4)	
I-J	-1926 / 0	-91.8	-91.8 0.05 (1)	4.83	O-I	-149 / 0 0.09 (1)	
J-K	-2106 / 0	-91.8	-91.8 0.11 (1)	4.60	N-J	0 / 810 0.18 (1)	
K-L	0 / 28	-91.8	-91.8 0.12 (1)	10.00	U-C	-2733 / 0 0.93 (1)	
U-B	-263 / 0	0.0	0.0 0.03 (1)	7.81	N-K	0 / 2028 0.48 (1)	
M-K	-1918 / 0	0.0	0.0 0.19 (1)	8.07	I-N	-1648 / 0 0.25 (1)	
U-T	0 / 2206	-18.5	-18.5 0.48 (1)	10.00			
T-S	0 / 2293	-18.5	-18.5 0.48 (1)	10.00			
S-R	0 / 2293	-18.5	-18.5 0.48 (1)	10.00			
R-Q	0 / 3191	-18.5	-18.5 0.58 (1)	10.00			
Q-P	0 / 2495	-18.5	-18.5 0.49 (1)	10.00			
P-O	0 / 2495	-18.5	-18.5 0.49 (1)	10.00			
O-N	0 / 2631	-18.5	-18.5 0.51 (1)	10.00			
N-M	0 / 0	-18.5	-18.5 0.09 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.09")
 CALCULATED VERT. DEFL. (LL) = L/999 (0.18")
 ALLOWABLE DEFL. (TL) = L/360 (1.09")
 CALCULATED VERT. DEFL. (TL) = L/999 (0.35")

CSI: TC=0.88/1.00 (H-I), BC=0.58/1.00 (Q-R), WB=0.93/1.00 (C-U), SS=0.24/1.00 (D-E-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 818 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.88 (U) (INPUT = 0.90)
 JSI METAL = 0.80 (I) (INPUT = 1.00)

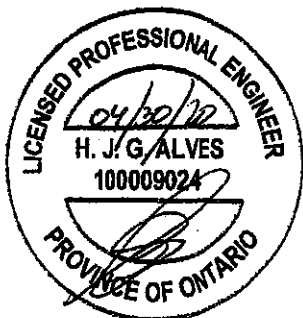

Structural component only
 DWG# T-2007970

JOB NAME 408314	TRUSS NAME T75	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 5 Oct 20 2019 MTEK Industries, Inc. Thu Apr 30 08:32:37 2020 Page 1
ID:85G6Bk99WNGzVGUuF_Z1BzizB3-VoCCQATyo3WRZb7TdRTa4x6s_HS.ktspm12bplLbWO
15-11-0 18-3-12 18-3-12 21-1-10 53-14 26-5-8 5-4-8 31-10-0 33-1-8
Scale = 1:52.5

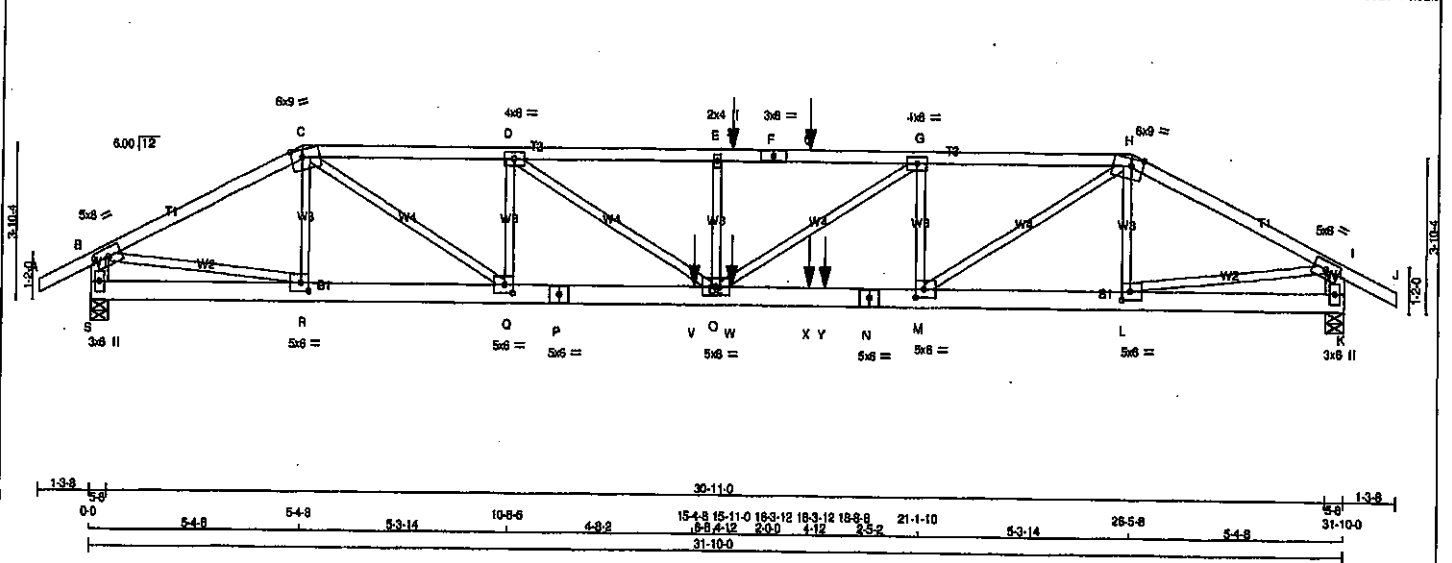

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2 SPF
C - F	2x4	DRY	No.2 SPF
F - H	2x4	DRY	No.2 SPF
H - J	2x4	DRY	No.2 SPF
S - B	2x8	DRY	No.2 SPF
K - I	2x8	DRY	No.2 SPF
S - P	2x8	DRY	No.2 SPF
P - N	2x8	DRY	No.2 SPF
N - K	2x8	DRY	No.2 SPF
ALL WEBS EXCEPT	2x3	DRY	No.2 SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
A-C	12	TOP
C-F	12	SIDE(0.0)
F-H	12	SIDE(0.0)
H-J	12	TOP
S-B	2	TOP
K-I	2	TOP
BOTTOM CHORDS: (0.122'x3') SPIRAL NAILS		
S-P	2	TOP
P-N	2	SIDE(0.0)
N-K	2	TOP
WEBS: (0.122'x3') SPIRAL NAILS		
2x3	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	DOWN	UPLIFT	IN-SX
S	3147	0	0	5-8
K	3325	0	0	5-8

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
S	2223	1471 / 0
K	2348	1559 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.67 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LG1 MAX (PLF)	MAX. UNBRAC LENGTH	MEMB. FORCE (LBS)
FR-TO				
A-B	0 / 28	-91.8	-91.8	0.07 (1)
B-C	-4742 / 0	-91.8	-91.8	0.41 (1)
C-D	-7531 / 0	-91.8	-91.8	0.49 (1)
D-E	-6793 / 0	-91.8	-91.8	0.68 (1)
E-F	-6793 / 0	-91.8	-91.8	0.72 (1)
F-G	-6793 / 0	-91.8	-91.8	0.72 (1)
G-H	-6793 / 0	-91.8	-91.8	0.72 (1)
H-I	-6793 / 0	-91.8	-91.8	0.72 (1)
I-J	-6793 / 0	-91.8	-91.8	0.72 (1)
J-K	-6793 / 0	-91.8	-91.8	0.72 (1)
K-L	-6793 / 0	-91.8	-91.8	0.72 (1)
L-M	-6793 / 0	-91.8	-91.8	0.72 (1)
M-N	-6793 / 0	-91.8	-91.8	0.72 (1)
N-O	-6793 / 0	-91.8	-91.8	0.72 (1)
O-P	-6793 / 0	-91.8	-91.8	0.72 (1)
P-Q	-6793 / 0	-91.8	-91.8	0.72 (1)
Q-R	-6793 / 0	-91.8	-91.8	0.72 (1)
R-S	-6793 / 0	-91.8	-91.8	0.72 (1)
S-T	-6793 / 0	-91.8	-91.8	0.72 (1)
T-U	-6793 / 0	-91.8	-91.8	0.72 (1)
U-V	-6793 / 0	-91.8	-91.8	0.72 (1)
V-W	-6793 / 0	-91.8	-91.8	0.72 (1)
W-X	-6793 / 0	-91.8	-91.8	0.72 (1)
X-Y	-6793 / 0	-91.8	-91.8	0.72 (1)
Y-Z	-6793 / 0	-91.8	-91.8	0.72 (1)
Z-A	-6793 / 0	-91.8	-91.8	0.72 (1)

FACTORED CONCENTRATED LOADS (LBS)	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
JT	18-3-12	-93	-93	---	BACK	VERT	TOTAL	---	C1
U	18-3-12	-93	-93	---	BACK	VERT	TOTAL	---	C1
V	15-4-8	-1324	-1324	---	BACK	VERT	TOTAL	---	C1
W	18-3-12	-23	-23	---	BACK	VERT	TOTAL	---	C1
X	18-3-12	-23	-23	---	BACK	VERT	TOTAL	---	C1
Y	18-8-8	-1157	-1157	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

BOT CH. LL = 6.0 PSF

DL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.06")

CALCULATED VERT. DEFL.(LL) = L/989 (0.28")

ALLOWABLE DEFL.(TL) = L/360 (1.06")

CALCULATED VERT. DEFL.(TL) = L/748 (0.51")

CSI: TC=0.72/1.00 (E-G:1), BC=0.97/1.00 (M-O:1)

WS=0.58/1.00 (I-L:1), SS=0.44/1.00 (O-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(FSL) (PL) (PLJ)

MAX MIN MAX MIN MAX MIN


MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (Q) (INPUT = 0.90)

JSI METAL= 0.92 (N) (INPUT = 1.00)

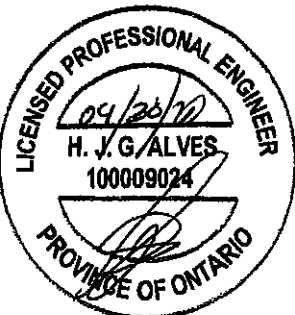

Structural component only
DWG# T-2007971 1/2

CONTINUED ON PAGE 2

JOB NAME 408314	TRUSS NAME T75	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 08:32:37 2020 Page 2
ID:65GeBk99WNGszVGuuF_Z1BzizB3-VoCCQATvo3WRZb7TdRTa4x6s_HS.xlpsml2bpzLbWQ


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-I	MT20	5.0	8.0		
C	TTWW-m	MT20	6.0	9.0	2.25	3.50
D	TMVW-I	MT20	4.0	6.0		
E	TMVW-w	MT20	2.0	4.0		
F	TS-I	MT20	3.0	8.0		
G	TMVW-I	MT20	4.0	6.0		
H	TTWW-m	MT20	6.0	9.0	2.25	3.50
I	TMVW-I	MT20	5.0	8.0		
K	BMV1-p	MT20	3.0	6.0		
L, M, Q, R						
L	BMVW-I	MT20	6.0	6.0	2.50	2.50
N	BS-I	MT20	5.0	6.0		
O	BMVWV-I	MT20	5.0	6.0		
P	BS-I	MT20	5.0	6.0		
S	BMV1-p	MT20	3.0	6.0		



Structural component only
DWG# T-2007971 *7/2*

JOB NAME 408314	TRUSS NAME T76	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

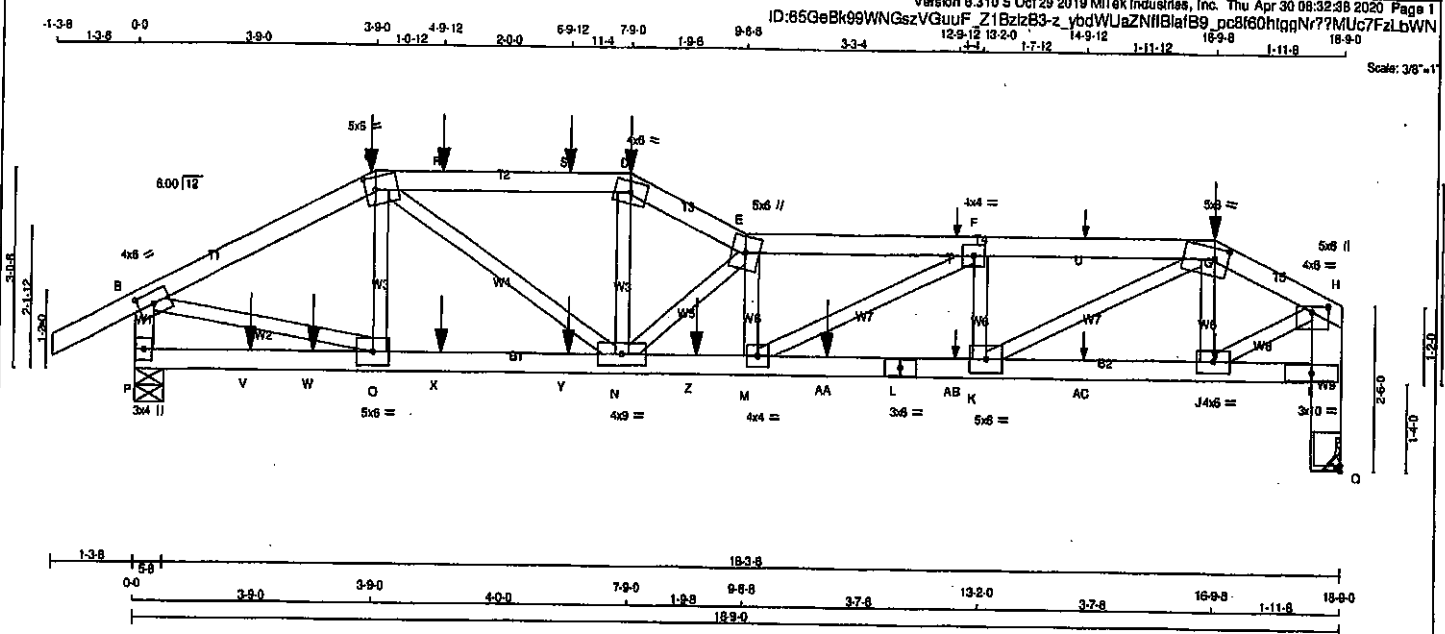

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - H	2x4	DRY	No.2	SPF
P - B	2x4	DRY	No.2	SPF
Q - H	2x6	DRY	No.2	SPF
P - L	2x4	DRY	No.2	SPF
L - I	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	8.0	2.00	3.00
C	TTWW-m	MT20	5.0	8.0	2.25	1.75
D	TTW-m	MT20	4.0	8.0		
E	TTWW+m	MT20	5.0	8.0		
F	TMVW-t	MT20	4.0	8.0		
G	TTWW-m	MT20	5.0	8.0	2.00	2.50
H	TMVW-p	MT20	4.0	8.0	1.00	3.00
I	BVM-t	MT20	3.0	10.0		
J	BMVW-t	MT20	4.0	8.0		
K	BMVW-t	MT20	5.0	8.0		
L	BS-t	MT20	3.0	8.0		
M	BMVW-t	MT20	4.0	8.0		
N	BMVW-t	MT20	4.0	8.0		
O	BMVW-t	MT20	5.0	8.0		
P	BMV-t+p	MT20	3.0	4.0		
Q	EBS-t	MT20	5.0	8.0		1.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
P	1328 0	1328 0	0 0	5-8
Q	1139 0	1139 0	0 0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT Q. MINIMUM BEARING LENGTH AT JOINT Q = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM/LIVE	WIND	DEAD	SOIL
P	935	638 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0
Q	805	633 / 0	0 / 0	0 / 0	0 / 0	272 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.74 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		MAX. UNBRACED LENGTH	WEBS	FACTORED	
	MAX. FORCE (LBS)	VERT. LOAD (LBS)	MAX. (PLF)	CSI (LC)			MAX. FORCE (LBS)	MAX. CSI (LC)
FR-TO						FR-TO		
A-B	0 / 28	-91.8	-91.8	0.13 (1)	10.00	C-C	-219 / 0	0.04 (1)
B-C	-1542 / 0	-91.8	-91.8	0.29 (1)	4.84	C-N	0 / 775	0.19 (1)
C-R	-2004 / 0	-91.8	-91.8	0.38 (1)	4.31	N-D	0 / 813	0.15 (1)
R-S	-2004 / 0	-91.8	-91.8	0.38 (1)	4.31	N-E	-1415 / 0	0.27 (1)
S-D	-2004 / 0	-91.8	-91.8	0.38 (1)	4.31	M-E	-229 / 0	0.04 (1)
D-E	-2214 / 0	-91.8	-91.8	0.12 (1)	4.48	M-F	0 / 584	0.14 (1)
E-T	-2981 / 0	-91.8	-91.8	0.30 (1)	3.74	K-F	-639 / 0	0.10 (1)
T-F	-2981 / 0	-91.8	-91.8	0.30 (1)	3.74	K-G	0 / 1550	0.38 (1)
F-U	-2491 / 0	-91.8	-91.8	0.28 (1)	4.09	J-G	-400 / 0	0.07 (1)
U-G	-2491 / 0	-91.8	-91.8	0.28 (1)	4.09	B-O	0 / 1412	0.35 (1)
G-H	-1288 / 0	-91.8	-91.8	0.09 (1)	5.81	J-H	0 / 1226	0.30 (1)
H-P	-1288 / 0	0.0	0.0	0.14 (1)	7.08			
P-B	-1139 / 0	0.0	0.0	0.09 (1)	7.81			
Q-I	-1139 / 0	0.0	0.0	0.08 (1)	7.81			
I-H	-1132 / 0	0.0	0.0	0.08 (1)	7.81			

P-V	0 / 0	-18.5	-18.5	0.08 (4)	10.00
V-W	0 / 0	-18.5	-18.5	0.08 (4)	10.00
W-O	0 / 0	-18.5	-18.5	0.08 (4)	10.00
O-X	0 / 1370	-18.5	-18.5	0.28 (1)	10.00
X-Y	0 / 1370	-18.5	-18.5	0.28 (1)	10.00
Y-N	0 / 1370	-18.5	-18.5	0.28 (1)	10.00
N-Z	0 / 2994	-18.5	-18.5	0.59 (1)	10.00
Z-M	0 / 2994	-18.5	-18.5	0.59 (1)	10.00
M-AA	0 / 2481	-18.5	-18.5	0.52 (1)	10.00
AA-L	0 / 2481	-18.5	-18.5	0.52 (1)	10.00
L-AB	0 / 2481	-18.5	-18.5	0.52 (1)	10.00
AB-K	0 / 2481	-18.5	-18.5	0.52 (1)	10.00
K-AC	0 / 1109	-18.5	-18.5	0.23 (1)	10.00
AC-J	0 / 1109	-18.5	-18.5	0.23 (1)	10.00
J-I	0 / 0	-18.5	-18.5	0.04 (4)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	3-9-0	-15	-17	FRONT	VERT	DEAD	---	C1
C	3-4-0	-74	-74	FRONT	VERT	SNOW	---	C1
D	7-9-0	-15	-17	FRONT	VERT	DEAD	---	C1
D	7-9-0	-74	-74	FRONT	VERT	SNOW	---	C1
G	18-9-8	-6	-7	FRONT	VERT	DEAD	---	C1
G	18-9-8	-3	-3	BACK	VERT	TOTAL	---	C1

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***

GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.

LOADS WERE DERIVED FROM USER INPUT

NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.63")

CALCULATED VERT. DEFL.(LL) = L/999 (0.11")

ALLOWABLE DEFL.(TL) = L/360 (0.63")

CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CSI: TC=0.38/1.00 (C-D-I), BC=0.58/1.00 (M-N-I), WB=0.38/1.00 (G-K-I), SS=0.18/1.00 (C-D-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.85 (E) (INPUT = 0.90)

JSI METAL=0.81 (L) (INPUT = 1.00)



Structural component only
DWG# T-2007972 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408314	T76	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 08:32:39 2020 Page 2
ID:65GeBk99WNGszVGUuF Z1BzizB3-z ybdWUaZNI8laB9 pc8f60htqN??MUc7FzLbWN

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	16-9-8	-26	-26	---	FRONT	VERT	SNOW	---	C1
J	16-9-12	1	1	---	BACK	VERT	TOTAL	---	C1
R	4-9-12	-21	-21	---	BACK	VERT	TOTAL	---	C1
S	6-9-12	-24	-24	---	BACK	VERT	TOTAL	---	C1
T	12-9-12	1	1	---	BACK	VERT	TOTAL	---	C1
U	14-9-12	1	1	---	BACK	VERT	TOTAL	---	C1
V	1-9-12	-3	-3	---	BACK	VERT	TOTAL	---	C1
W	2-9-12	-3	-3	---	BACK	VERT	TOTAL	---	C1
X	4-9-12	-3	-3	---	BACK	VERT	TOTAL	---	C1
Y	6-9-12	-3	-3	---	BACK	VERT	TOTAL	---	C1
Z	8-9-12	-3	-3	---	BACK	VERT	TOTAL	---	C1
AA	10-9-12	-3	-3	---	BACK	VERT	TOTAL	---	C1
AB	12-9-12	1	1	---	BACK	VERT	TOTAL	---	C1
AC	14-9-12	1	1	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007972 7/2

JOB NAME 408314	TRUSS NAME T77	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:32:40 2020 Page 1
ID:85G6Bk99WNGzVGuuF_Z1BzizB3-wM3L2CVq5_v0C3k2la0HhZkJUY18AZITgzlB8zLbWL
Scale = 1:29.3

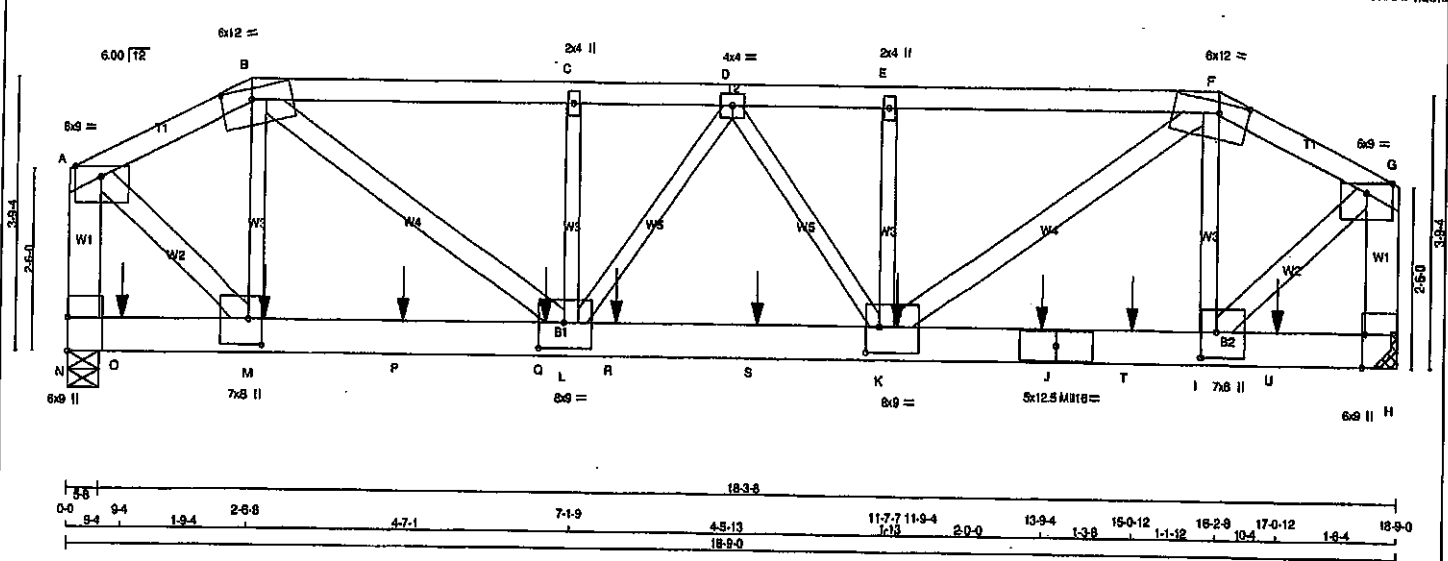

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
A - B	2x4	DRY No.2	SPF
B - F	2x4	DRY No.2	SPF
F - G	2x4	DRY No.2	SPF
N - A	2x6	DRY No.2	SPF
H - G	2x6	DRY No.2	SPF
N - J	2x6	DRY 2100F 1.8E	SPF
J - H	2x6	DRY 2100F 1.8E	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF
B - L	2x4	DRY No.2	SPF
K - F	2x4	DRY No.2	SPF
A - M	2x4	DRY No.2	SPF
I - G	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-B	12	TOP
B-F	12	TOP
F-G	12	TOP
N-A	12	TOP
H-G	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
N-J	12	SIDE(197.8)
J-H	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
M-B	6	SIDE(284.2)
E-K	6	SIDE(284.2)
2x3	6	
2x4	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
N	10223	0	10223	0	5-8
H	9555	0	9555	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 4-0.

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
N	7221	4788 / 0	0 / 0	0 / 0	0 / 0	2433 / 0	0 / 0
H	8749	4478 / 0	0 / 0	0 / 0	0 / 0	2273 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N
BEARING SIZE FACTOR = 1.15 AT JNT(S) N (BASED ON SUPPORT DEPTH = 1-8)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 1.78 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	-7921 / 0	A-B	-1854 / 0
B-C	-13888 / 0	B-L	0 / 8537
C-D	-13888 / 0	L-C	-311 / 0
D-E	-13874 / 0	K-E	-317 / 0
E-F	-13874 / 0	K-F	0 / 8063
F-G	-8098 / 0	I-F	-1491 / 0
N-A	-9315 / 0	A-M	0 / 8048
H-G	-9518 / 0	I-G	0 / 9246
		L-D	0 / 82
		D-K	-298 / 0
N-O	0 / 0		
O-M	0 / 0		
M-P	0 / 7018		
P-Q	0 / 7018		
Q-L	0 / 7018		
L-R	0 / 13837		
R-S	0 / 13837		
S-X	0 / 13837		
K-J	0 / 7186		
J-T	0 / 7186		
T-I	0 / 7186		
I-U	0 / 0		
U-H	0 / 0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
J	13-9-4	-1771	-1771	---	FRONT	VERT	TOTAL	---	C1
K	11-9-4	-1771	-1771	---	FRONT	VERT	TOTAL	---	C1
M	2-9-4	-1771	-1771	---	FRONT	VERT	TOTAL	---	C1
O	9-4	-1773	-1773	---	FRONT	VERT	TOTAL	---	C1
P	4-9-4	-1771	-1771	---	FRONT	VERT	TOTAL	---	C1
Q	6-9-4	-1771	-1771	---	FRONT	VERT	TOTAL	---	C1
R	7-9-4	-1771	-1771	---	FRONT	VERT	TOTAL	---	C1
S	9-9-4	-1771	-1771	---	FRONT	VERT	TOTAL	---	C1
T	15-0-12	-1771	-1771	---	FRONT	VERT	TOTAL	---	C1
U	17-0-12	-1771	-1771	---	FRONT	VERT	TOTAL	---	C1

TOTAL WEIGHT = 2 X 97 = 195 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.62")
CALCULATED VERT. DEFL.(LL) = L/999 (0.17")
ALLOWABLE DEFL.(TL) = L/360 (0.62")
CALCULATED VERT. DEFL.(TL) = L/704 (0.32")
CSI: TC=0.97/1.00 (B-C:1), BC=0.65/1.00 (K-L:1), WB=0.82/1.00 (G-I:1), SS=0.84/1.00 (L-M:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1887 788 1987 1656
MI16 438 278 2341 1245 4283 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.80 (B) (INPUT = 0.80)

JSI METAL= 0.93 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007973/1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408314	T77	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:32:40 2020 Page 2
ID:65GeBk99WNGszVGuuF Z1BzizB3-wM3L2GVq5 v0Q3k2!a0HhZkjlUY18AZITqzIB8zLhVWl

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWW-p	MT20	6.0	9.0	Edge	
B	TTWW-m	MT20	6.0	12.0	1.75	5.00
C	TMWW-w	MT20	2.0	4.0		
D	TMWW-l	MT20	4.0	4.0		
E	TMWW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	6.0	12.0	1.75	5.00
G	TMWW-p	MT20	6.0	9.0	Edge	
H	BMV1-t	MT20	6.0	9.0	Edge	0.50
I	BMWW-t	MT20	7.0	8.0	4.25	2.25
J	BS-l	M118	5.0	12.5		
K	BMWW-t	MT20	8.0	9.0	4.25	2.25
L	BMWW-t	MT20	8.0	9.0	4.25	4.25
M	BMWW-t	MT20	7.0	8.0	4.25	2.25
N	BMV1-t	MT20	6.0	9.0	5.50	

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) CT: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007973 *yk*


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408314	T78S	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 08:32:41 2020 Page 1
ID:85GbK99WNGszVGUuF_Z1BzB3-OZdjFYWSs1s2CJEsHYWenHgVuxmtgGRhKjGkazLbWK

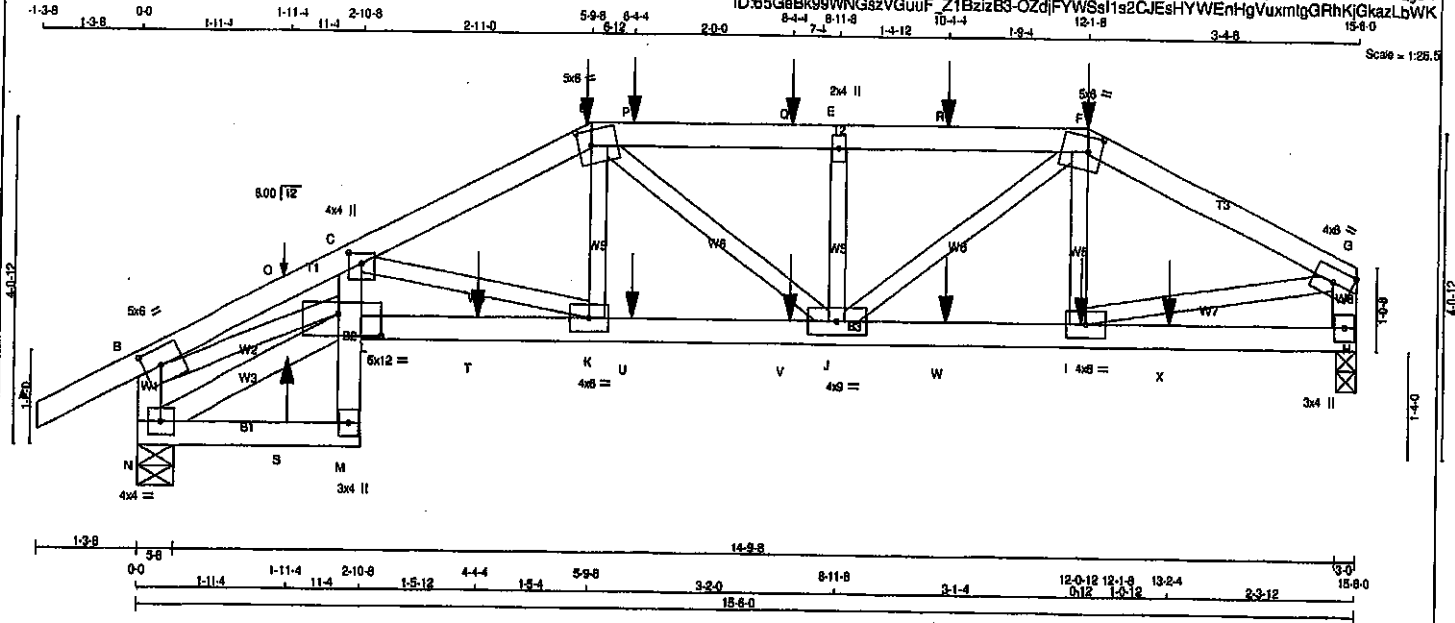

JOB NAME 408314	TRUSS NAME T79	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

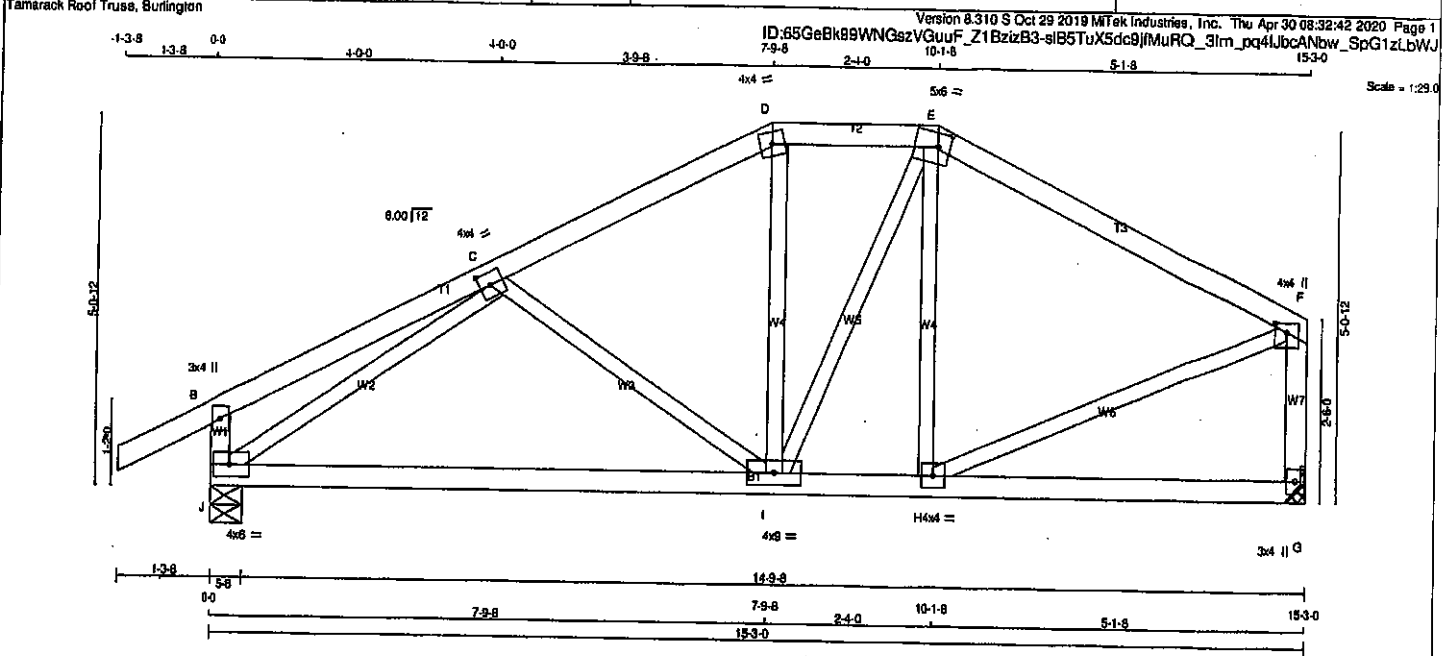

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS	2x4	DRY	No.2
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
J - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - N	2x4	DRY	No.2
N - O	2x4	DRY	No.2
O - P	2x4	DRY	No.2
P - Q	2x4	DRY	No.2
Q - R	2x4	DRY	No.2
R - S	2x4	DRY	No.2
S - T	2x4	DRY	No.2
T - U	2x4	DRY	No.2
U - V	2x4	DRY	No.2
V - W	2x4	DRY	No.2
W - X	2x4	DRY	No.2
X - Y	2x4	DRY	No.2
Y - Z	2x4	DRY	No.2
Z - A	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)			
JT	TYPE	PLATES	W LEN Y X
B	TMV+p	MT20	3.0 4.0
C	TMVW-t	MT20	4.0 4.0 2.00 1.75
D	TTW-m	MT20	4.0 4.0
E	TTWV-m	MT20	5.0 6.0 2.25 2.00
F	TMVW+p	MT20	4.0 4.0 1.50 2.00
G	BMV+p	MT20	3.0 4.0
H	BMVW-t	MT20	4.0 4.0
I	BMVWV-t	MT20	4.0 4.0
J	BMVWV-t	MT20	4.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT RECD
G	841 0	841 0	841 0
J	965 0	965 0	965 0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST LOASE COMBINED	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
G	595	390 / 0	0 / 0	0 / 0	0 / 0	0 / 0	204 / 0	0 / 0
J	680	460 / 0	0 / 0	0 / 0	0 / 0	0 / 0	221 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO			
A-B	0 / 28	-91.8	-91.8
B-C	0 / 18	-91.8	-91.8
C-D	-788 / 0	-91.8	-91.8
D-E	-691 / 0	-91.8	-91.8
E-F	-684 / 0	-91.8	-91.8
F-G	-264 / 0	0.0	0.0
G-H	-798 / 0	0.0	0.0
H-I	0 / 891	-18.5	-18.5
I-J	0 / 607	-18.5	-18.5
J-K	0 / 0	-18.5	-18.5

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.51")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.51")
CALCULATED VERT. DEFL. (TL) = L/999 (0.12")

CSI: TC=0.32/1.00 (E-F:1), BC=0.32/1.00 (I-J:4), WB=0.41/1.00 (C-J:1), SSI=0.18/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.77 (C) (INPUT = 0.90)
JSI METAL= 0.39 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007975

JOB NAME 408314	TRUSS NAME T80	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 08:32:44 2020 Page 1			

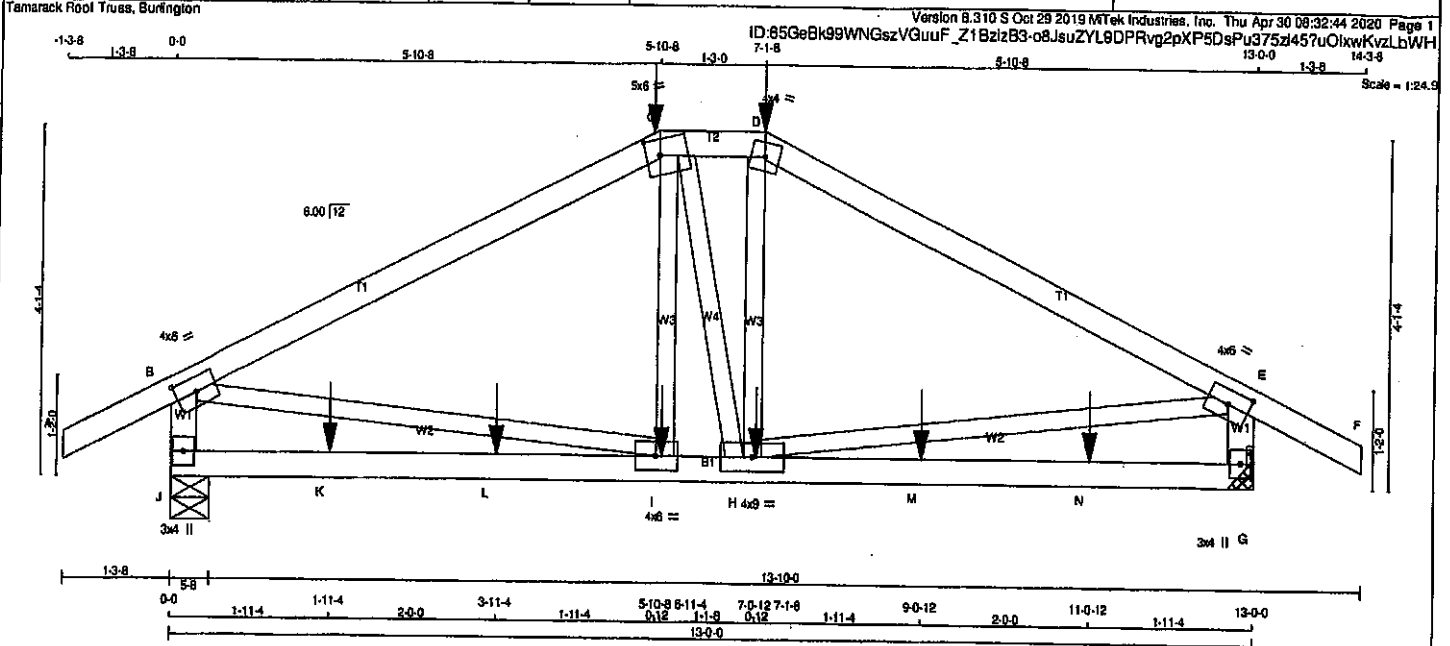

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS	2x4	DRY	No.2
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
J - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - N	2x4	DRY	No.2
N - O	2x4	DRY	No.2
O - P	2x4	DRY	No.2
P - Q	2x4	DRY	No.2
Q - R	2x4	DRY	No.2
R - S	2x4	DRY	No.2
S - T	2x4	DRY	No.2
T - U	2x4	DRY	No.2
U - V	2x4	DRY	No.2
V - W	2x4	DRY	No.2
W - X	2x4	DRY	No.2
X - Y	2x4	DRY	No.2
Y - Z	2x4	DRY	No.2
Z - AA	2x4	DRY	No.2
AA - AB	2x4	DRY	No.2
AB - AC	2x4	DRY	No.2
AC - AD	2x4	DRY	No.2
AD - AE	2x4	DRY	No.2
AE - AF	2x4	DRY	No.2
AF - AG	2x4	DRY	No.2
AG - AH	2x4	DRY	No.2
AH - AI	2x4	DRY	No.2
AI - AJ	2x4	DRY	No.2
AJ - AK	2x4	DRY	No.2
AK - AL	2x4	DRY	No.2
AL - AM	2x4	DRY	No.2
AM - AN	2x4	DRY	No.2
AN - AO	2x4	DRY	No.2
AO - AP	2x4	DRY	No.2
AP - AQ	2x4	DRY	No.2
AQ - AR	2x4	DRY	No.2
AR - AS	2x4	DRY	No.2
AS - AT	2x4	DRY	No.2
AT - AU	2x4	DRY	No.2
AU - AV	2x4	DRY	No.2
AV - AW	2x4	DRY	No.2
AW - AX	2x4	DRY	No.2
AX - AY	2x4	DRY	No.2
AY - AZ	2x4	DRY	No.2
AZ - BA	2x4	DRY	No.2
BA - BB	2x4	DRY	No.2
BB - BC	2x4	DRY	No.2
BC - BD	2x4	DRY	No.2
BD - BE	2x4	DRY	No.2
BE - BF	2x4	DRY	No.2
BF - BG	2x4	DRY	No.2
BG - BH	2x4	DRY	No.2
BH - BI	2x4	DRY	No.2
BI - BJ	2x4	DRY	No.2
BJ - BK	2x4	DRY	No.2
BK - BL	2x4	DRY	No.2
BL - BM	2x4	DRY	No.2
BM - BN	2x4	DRY	No.2
BN - BO	2x4	DRY	No.2
BO - BP	2x4	DRY	No.2
BP - BQ	2x4	DRY	No.2
BQ - BR	2x4	DRY	No.2
BR - BS	2x4	DRY	No.2
BS - BT	2x4	DRY	No.2
BT - BU	2x4	DRY	No.2
BU - BV	2x4	DRY	No.2
BV - BW	2x4	DRY	No.2
BW - BX	2x4	DRY	No.2
BX - BY	2x4	DRY	No.2
BY - BZ	2x4	DRY	No.2
BZ - CA	2x4	DRY	No.2
CA - CB	2x4	DRY	No.2
CB - CC	2x4	DRY	No.2
CC - CD	2x4	DRY	No.2
CD - CE	2x4	DRY	No.2
CE - CF	2x4	DRY	No.2
CF - CG	2x4	DRY	No.2
CG - CH	2x4	DRY	No.2
CH - CI	2x4	DRY	No.2
CI - CJ	2x4	DRY	No.2
CJ - CK	2x4	DRY	No.2
CK - CL	2x4	DRY	No.2
CL - CM	2x4	DRY	No.2
CM - CN	2x4	DRY	No.2
CN - CO	2x4	DRY	No.2
CO - CP	2x4	DRY	No.2
CP - CQ	2x4	DRY	No.2
CQ - CR	2x4	DRY	No.2
CR - CS	2x4	DRY	No.2
CS - CT	2x4	DRY	No.2
CT - CU	2x4	DRY	No.2
CU - CV	2x4	DRY	No.2
CV - CW	2x4	DRY	No.2
CW - CX	2x4	DRY	No.2
CX - CY	2x4	DRY	No.2
CY - CZ	2x4	DRY	No.2
CZ - DA	2x4	DRY	No.2
DA - DB	2x4	DRY	No.2
DB - DC	2x4	DRY	No.2
DC - DD	2x4	DRY	No.2
DD - DE	2x4	DRY	No.2
DE - DF	2x4	DRY	No.2
DF - DG	2x4	DRY	No.2
DG - DH	2x4	DRY	No.2
DH - DI	2x4	DRY	No.2
DI - DJ	2x4	DRY	No.2
DJ - DK	2x4	DRY	No.2
DK - DL	2x4	DRY	No.2
DL - DM	2x4	DRY	No.2
DM - DN	2x4	DRY	No.2
DN - DO	2x4	DRY	No.2
DO - DP	2x4	DRY	No.2
DP - DQ	2x4	DRY	No.2
DQ - DR	2x4	DRY	No.2
DR - DS	2x4	DRY	No.2
DS - DT	2x4	DRY	No.2
DT - DU	2x4	DRY	No.2
DU - DV	2x4	DRY	No.2
DV - DW	2x4	DRY	No.2
DW - DX	2x4	DRY	No.2
DX - DY	2x4	DRY	No.2
DY - DZ	2x4	DRY	No.2
DZ - EA	2x4	DRY	No.2
EA - EB	2x4	DRY	No.2
EB - EC	2x4	DRY	No.2
EC - ED	2x4	DRY	No.2
ED - EE	2x4	DRY	No.2
EE - EF	2x4	DRY	No.2
EF - EG	2x4	DRY	No.2
EG - EH	2x4	DRY	No.2
EH - EI	2x4	DRY	No.2
EI - EJ	2x4	DRY	No.2
EJ - EK	2x4	DRY	No.2
EK - EL	2x4	DRY	No.2
EL - EM	2x4	DRY	No.2
EM - EN	2x4	DRY	No.2
EN - EO	2x4	DRY	No.2
EO - EP	2x4	DRY	No.2
EP - EQ	2x4	DRY	No.2
EQ - ER	2x4	DRY	No.2
ER - ES	2x4	DRY	No.2
ES - ET	2x4	DRY	No.2
ET - EU	2x4	DRY	No.2
EU - EV	2x4	DRY	No.2
EV - EW	2x4	DRY	No.2
EW - EX	2x4	DRY	No.2
EX - EY	2x4	DRY	No.2
EY - EZ	2x4	DRY	No.2
EZ - FA	2x4	DRY	No.2
FA - FB	2x4	DRY	No.2
FB - FC	2x4	DRY	No.2
FC - FD	2x4	DRY	No.2
FD - FE	2x4	DRY	No.2
FE - FF	2x4	DRY	No.2
FF - FG	2x4	DRY	No.2
FG - FH	2x4	DRY	No.2
FH - FI	2x4	DRY	No.2
FI - FJ	2x4	DRY	No.2
FJ - FK	2x4	DRY	No.2
FK - FL	2x4	DRY	No.2
FL - FM	2x4	DRY	No.2
FM - FN	2x4	DRY	No.2
FN - FO	2x4	DRY	No.2
FO - FP	2x4	DRY	No.2
FP - FQ	2x4	DRY	No.2
FQ - FR	2x4	DRY	No.2
FR - FS	2x4	DRY	No.2
FS - FT	2x4	DRY	No.2
FT - FU	2x4	DRY	No.2
FU - FV	2x4	DRY	No.2
FV - FW	2x4	DRY	No.2
FW - FX	2x4	DRY	No.2
FX - FY	2x4	DRY	No.2
FY - FZ	2x4	DRY	No.2
FZ - GA	2x4	DRY	No.2
GA - GB	2x4	DRY	No.2
GB - GC	2x4	DRY	No.2
GC - GD	2x4	DRY	No.2
GD - GE	2x4	DRY	No.2
GE - GF	2x4	DRY	No.2
GF - GG	2x4	DRY	No.2
GG - GH	2x4	DRY	No.2
GH - GI	2x4	DRY	No.2
GI - GJ	2x4	DRY	No.2
GJ - GK	2x4	DRY	No.2
GK - GL	2x4	DRY	No.2
GL - GM	2x4	DRY	No.2
GM - GN	2x4	DRY	No.2
GN - GO	2x4	DRY	No.2
GO - GP	2x4	DRY	No.2
GP - GQ	2x4	DRY	No.2
GQ - GR	2x4	DRY	No.2
GR - GS	2x4	DRY	No.2
GS - GT	2x4	DRY	No.2
GT - GU	2x4	DRY	No.2
GU - GV	2x4	DRY	No.2
GV - GW	2x4	DRY	No.2
GW - GX	2x4	DRY	No.2
GX - GY	2x4	DRY	No.2
GY - GZ	2x4	DRY	No.2
GZ - HA	2x4	DRY	No.2
HA - HB	2x4	DRY	No.2
HB - HC	2x4	DRY	No.2
HC - HD	2x4	DRY	No.2
HD - HE	2x4	DRY	No.2
HE - HF	2x4	DRY	No.2
HF - HG	2x4	DRY	No.2
HG - HH	2x4	DRY	No.2
HH - HI	2x4	DRY	No.2
HI - HJ	2x4	DRY	No.2
HJ - HK	2x4	DRY	No.2
HK - HL	2x4	DRY	No.2
HL - HM	2x4	DRY	No.2
HM - HN	2x4	DRY	No.2
HN - HO	2x4	DRY	No.2
HO - HP	2x4	DRY	No.2
HP - HQ	2x4	DRY	No.2
HQ - HR	2x4	DRY	No.2
HR - HS	2x4	DRY	No.2
HS - HT	2x4	DRY	No.2
HT - HU	2x4	DRY	No.2
HU - HV	2x4	DRY	No.2
HV - HW	2x4	DRY	No.2
HW - HX	2x4	DRY	No.2
HX - HY	2x4	DRY	No.2
HY - HZ	2x4	DRY	No.2
HZ - IA	2x4	DRY	No.2
IA - IB	2x4	DRY	No.2
IB - IC	2x4	DRY	No.2
IC - ID	2x4	DRY	No.2
ID - IE	2x4	DRY	No.2
IE - IF	2x4	DRY	No.2
IF - IG	2x4	DRY	No.2
IG - IH	2x4	DRY	No.2
IH - II	2x4	DRY	No.2
II - IJ	2x4	DRY	No.2
IJ - IK	2x4	DRY	No.2
IK - IL	2x4	DRY	No.2
IL - IM	2x4	DRY	No.2
IM - IN	2x4	DRY	No.2
IN - IO	2x4	DRY	No.2
IO - IP	2x4	DRY	No.2
IP - IQ	2x4	DRY	No.2
IQ - IR	2x4	DRY	No.2
IR - IS	2x4	DRY	No.2
IS - IT	2x4	DRY	No.2
IT - IU	2x4	DRY	No.2
IU - IV	2x4	DRY	No.2
IV - IW	2x4	DRY	No.2
IW - IX	2x4	DRY	No.2
IX - IY	2x4	DRY	No.2
IY - IZ	2x4	DRY	No.2
IZ - JA	2x4	DRY	No.2
JA - JB	2x4	DRY	No.2
JB - JC	2x4	DRY	No.2
JC - JD	2x4	DRY	No.2
JD - JE	2x4	DRY	No.2
JE - JF	2x4	DRY	No.2
JF - JG	2x4	DRY	No.2
JG - JH	2x4	DRY	No.2
JH - JI	2x4	DRY	No.2
JI - JJ	2x4	DRY	No.2
JJ - JK	2x4	DRY	No.2
JK - JL	2x4	DRY	No.2
JL - JM	2x4	DRY	No.2
JM - JN	2x4	DRY	No.2
JN - JO	2x4	DRY	No.2
JO - JP	2x4	DRY	No.2
JP - JQ	2x4	DRY	No.2
JQ - JR	2x4	DRY	No.2
JR - JS	2x4	DRY	No.2
JS - JT	2x4	DRY	No.2
JT - JU	2x4	DRY	No.2
JU - JV	2x4	DRY	No.2
JV - JW	2x4	DRY	No.2
JW - JX	2x4	DRY	No.2
JX - JY	2x4	DRY	No.2
JY - JZ	2x4	DRY	No.2
JZ - KA	2x4	DRY	No.2
KA - KB	2x4	DRY	No.2
KB - KC	2x4	DRY	No.2
KC - KD	2x4	DRY	No.2
KD - KE	2x4	DRY	No.2
KE - KF	2x4	DRY	No.2
KF - KG	2x4	DRY	No.2
KG - KH	2x4	DRY	No.2
KH - KI	2x4	DRY	No.2
KI - KJ	2x4	DRY	No.2
KJ - KK	2x4	DRY	No.2
KK - KL	2x4	DRY	No.2
KL - KM	2x4	DRY	No.2
KM - KN	2x4	DRY	No.2
KN - KO	2x4	DRY	No.2
KO - KP	2x4	DRY	No.2
KP - KQ	2x4	DRY	No.2
KQ - KR	2x4	DRY	No.2
KR - KS	2x4	DRY	No.2
KS - KT	2x4	DRY	No.2
KT - KU	2x4	DRY	No.2
KU - KV	2x4	DRY	No.2
KV - KW	2x4	DRY	No.2
KW - KX	2x4	DRY	No.2
KX - KY	2x4	DRY	No.2
KY - KZ	2x4	DRY	No.2
KZ - LA	2x4	DRY	No.2
LA - LB	2x4	DRY	No.2
LB - LC	2x4	DRY	No.2
LC - LD	2x4	DRY	No.2
LD - LE	2x4	DRY	No.2
LE - LF	2x4	DRY	No.2
LF - LG	2x4	DRY	No.2
LG - LH	2x4	DRY	No.2
LH - LI	2x4	DRY	No.2
LI - LJ	2x4	DRY	No.2
LJ - LK	2x4	DRY	No.2
LK - LL	2x4	DRY	No.2
LL - LM	2x4	DRY	No.2
LM - LN	2x4	DRY	No.2
LN - LO	2x4	DRY	No.2
LO - LP	2x4	DRY	No.2
LP - LQ	2x4	DRY	No.2
LQ - LR	2x4	DRY	No.2
LR - LS	2x4	DRY	No.2

JOB NAME 408314	TRUSS NAME T81	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 08:32:45 2020 Page 1	

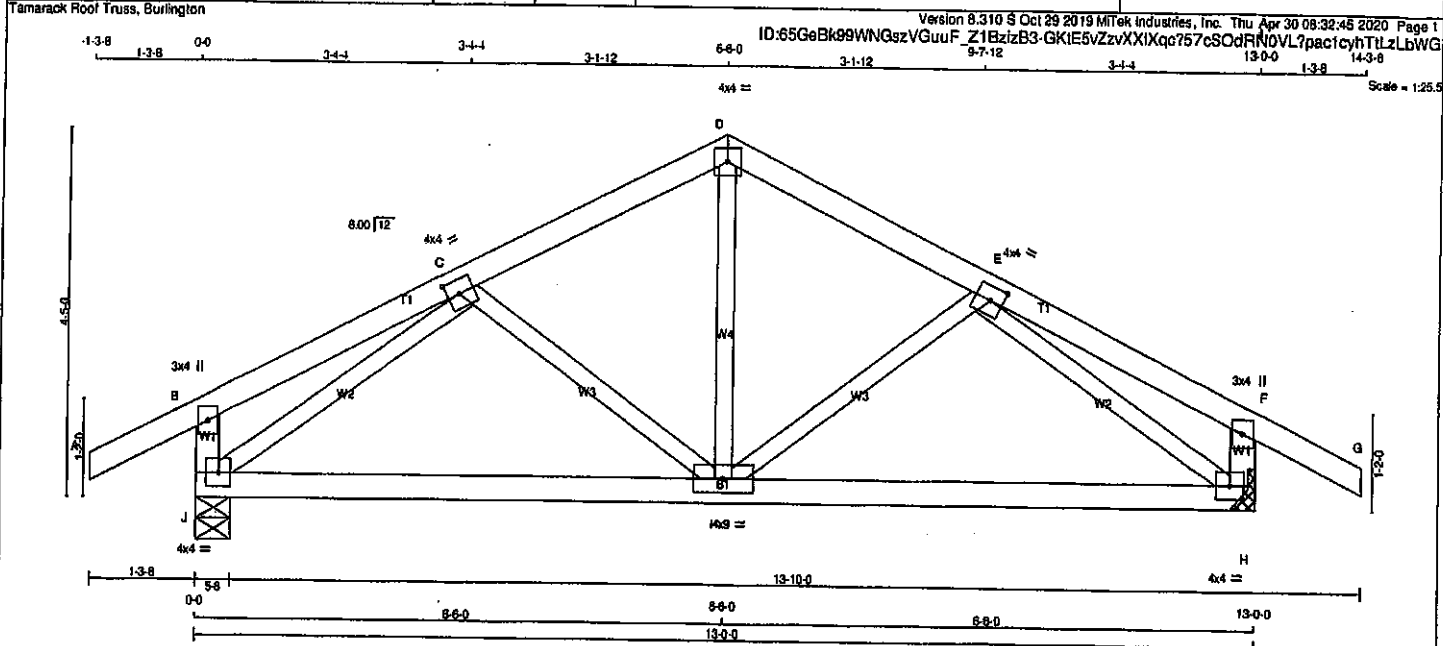

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMV-p	MT20	3.0	4.0
C	TMVW-t	MT20	4.0	4.0
D	TMVW-p	MT20	4.0	4.0
E	TMVW-t	MT20	4.0	4.0
F	TMV-p	MT20	3.0	4.0
H	BMVW-t	MT20	4.0	4.0
I	BMVW-t	MT20	4.0	4.0
J	BMVW-t	MT20	4.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	GROSS REACTION	BRG	BRG
J	VERT	841	0	0	5-8
H	HORIZ	841	0	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS
J	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
J	593	402 / 0 0 / 0 0 / 0 0 / 0 190 / 0 0 / 0
H	593	402 / 0 0 / 0 0 / 0 0 / 0 190 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		FR-TO	
A-B	0 / 28	-91.8 -91.8 0.12 (1)	10.00	I-D	0 / 355
B-C	0 / 14	-91.8 -91.8 0.14 (1)	10.00	I-E	-171 / 0
C-D	-672 / 0	-91.8 -91.8 0.11 (1)	6.25	C-I	-171 / 0
D-E	-672 / 0	-91.8 -91.8 0.11 (1)	6.25	J-C	-910 / 0
E-F	0 / 14	-91.8 -91.8 0.14 (1)	10.00	E-H	-910 / 0
F-G	0 / 28	-91.8 -91.8 0.12 (1)	10.00		
J-B	-242 / 0	0.0 0.0 0.02 (1)	7.81		
H-F	-242 / 0	0.0 0.0 0.02 (1)	7.81		
J-I	0 / 724	-18.5 -18.5 0.28 (4)	10.00		
I-H	0 / 724	-18.5 -18.5 0.28 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:		
TOP CH.	LL	= 25.6 PSF
	DL	= 8.0 PSF
BOT CH.	LL	= 0.0 PSF
	DL	= 7.4 PSF
TOTAL LOAD = 39.0 PSF		

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.43")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.43")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.14/1.00 (E-F:1), BC=0.28/1.00 (H-H:4), WB=0.25/1.00 (E-H:1), SS=0.13/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	818	354	1887
			788 1887 1858

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.81 (H) (INPUT = 0.90)
JSI METAL = 0.31 (C) (INPUT = 1.00)



Structural component only
DWG# T-2007977

JOB NAME 408314	TRUSS NAME T82	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 AMT&K Industries, Inc. Thu Apr 30 08:32:48 2020 Page 1 ID:65GeBk99WNGszVGuuF_Z1BzizB3-kWRclFabgqf98_BCIq7hxq_PpvguY4pBrCQ1PozLbWf			

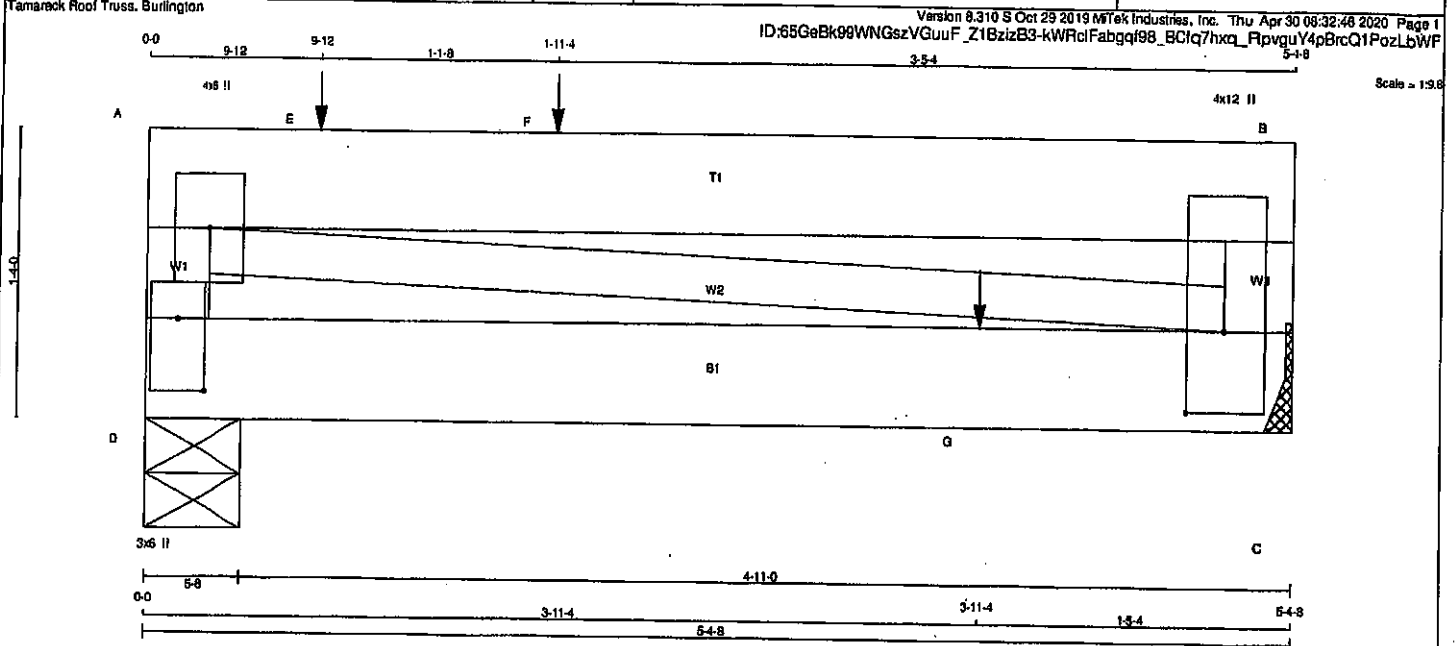

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	2x4	No.2	SPF
D - A	2x4	DRY	No.2
A - B	2x6	DRY	No.2
C - B	2x4	DRY	No.2
D - C	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
D-A 1 12	TOP	TOP
B-C 1 12	TOP	TOP
A-B 2 12	SIDE(0.0)	SIDE(0.0)
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
D-C 2 12	SIDE(14.0)	SIDE(14.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1 8		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	8.0		
B						
B	TMBMVW1+*+m	MT20	4.0	12.0	4.50	2.00
C	BMV1+p	MT20	3.0	6.0	4.00	1.50

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
D	1353	0	1353	0
C	1342	0	1342	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT C. MINIMUM BEARING LENGTH AT JOINT C = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	983	598 / 0	0 / 0	0 / 0	0 / 0	365 / 0	0 / 0
C	955	598 / 0	0 / 0	0 / 0	0 / 0	359 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
D-A	-1018 / 0	0.0	0.0 0.08 (1)	7.81	A-C	0 / 0	0.00 (1)
A-E	0 / 0	-91.8	-91.8 0.59 (1)	10.00			
E-F	0 / 0	-91.8	-91.8 0.59 (1)	10.00			
F-B	0 / 0	-91.8	-91.8 0.59 (1)	10.00			
C-B	-623 / 0	0.0	0.0 0.03 (1)	7.81			
D-G	0 / 0	-43.5	-43.5 0.36 (1)	10.00			
G-C	0 / 0	-43.5	-43.5 0.36 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
E	9-12	-178	-178	---	BACK	VERT	TOTAL	C1
F	1-11-4	-970	-970	---	TOP	VERT	TOTAL	C1
G	3-11-4	-822	-822	---	FRONT	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/899 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/989 (0.08")

CSI: TC=0.59/1.00 (A-B:1) , BC=0.38/1.00 (C-D:1) , WB=0.00/1.00 (A-C:1) , SS=0.34/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (FLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (A) (INPUT = 0.90)
JSI METAL= 0.07 (D) (INPUT = 1.00)




Structural component only
DWG# T-2007978

JOB NAME 408312	TRUSS NAME J1	QUANTITY 25	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 29 18:28:00 2020 Page 1
ID:DMCubINVR6Ts1Foe31v6l_zns11-87Uy6_bTAUWX8imvBT3_YYeCKMxnpCOQAbUvzLpgg

Scale = 1/288

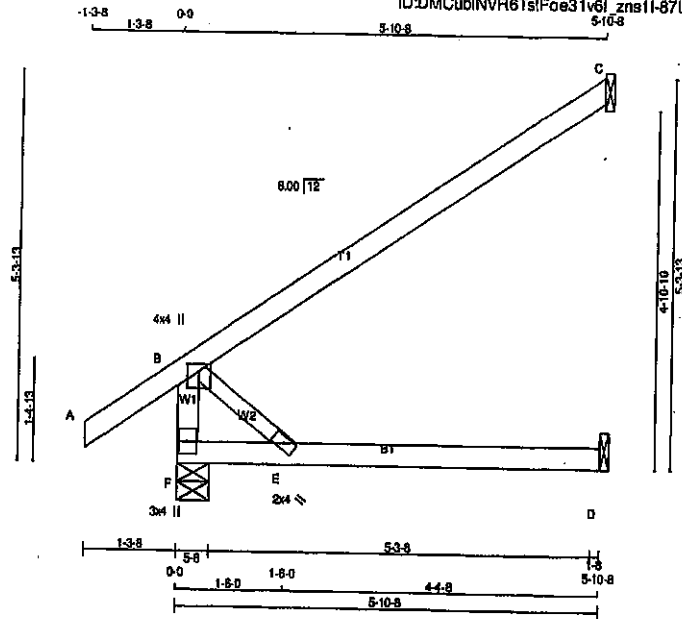

LUMBER				
N. L. G. A. RULES	SIZE	LUMBER	DESCR.	
CHORDS	2x4	No.2	SPF	
F - B	2x4	DRY	No.2	
A - C	2x4	DRY	No.2	
F - D	2x4	DRY	No.2	
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW+p	MT20	4.0	4.0 1.25 2.00
E	BMVW+p	MT20	2.0	4.0
F	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS				
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	DOWN	UPLIFT	IN-SX
F	450	0	0	5-8
C	270	0	0	1-8
D	54	0	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS				
JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND
	COMBINED	SNOW	LIVE	DEAD
F	318	221/0	0/0	95/0
C	186	150/0	0/0	35/0
D	43	0/0	0/0	43/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	UNBRAC LENGTH
F-B	-385/0	0.0	0.0 0.04 (1)	7.81
A-B	0/35	-91.8	-91.8 0.12 (1)	10.00
B-C	0/0	-91.8	-91.8 0.54 (1)	10.00
F-E	0/0	-18.5	-18.5 0.14 (4)	10.00
E-D	0/0	-18.5	-18.5 0.19 (4)	10.00

WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	UNBRAC LENGTH	FR-TO
B-E	0/0	0.00 (1)		

TOTAL WEIGHT = 25 X 19 = 480 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSI: TC=0.54/1.00 (B-C:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1867 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.28 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007880

JOB NAME 408313	TRUSS NAME J30	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:09:58 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns1l-oLmSBU0VWIG1kHWXbuULKXsqR0N8qGm2dO4zLbrd

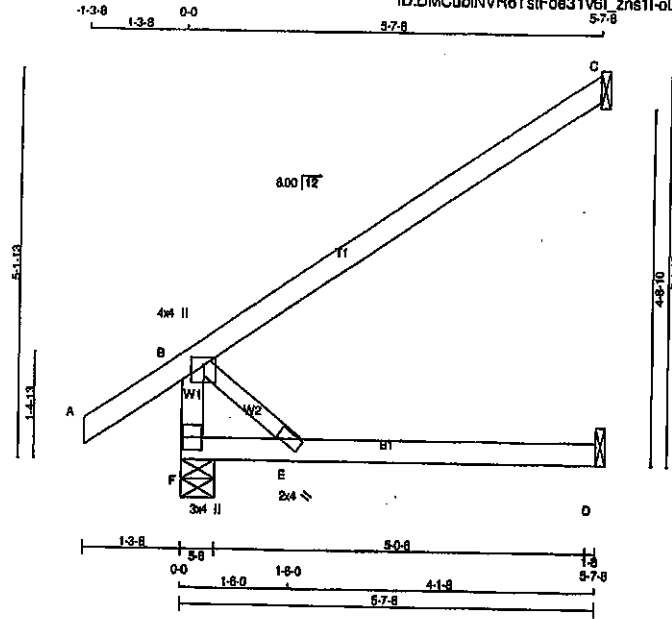

Scale = 1/28.1

LUMBER				
N. L. G. A. RULES	SIZE	LUMBER	DESCR.	
CHORDS	2x4	No.2	SPF	
F - B	2x4	DRY	SPF	
A - C	2x4	DRY	SPF	
F - D	2x4	DRY	SPF	
ALL WEBS	2x3	DRY	SPF	
DRY: SEASONED LUMBER.				

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.25	2.00
E BMVW+p	MT20	2.0	4.0		
F BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	HORIZ	BRG	IN-SX	BRG	IN-SX
F	436	0	436	0	0	5-8	5-8		
C	258	0	258	0	0	1-8	1-8		
D	52	0	52	0	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST LC CASE		MAX. MIN. COMPONENT REACTIONS		SNOW		LIVE		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	VERT	HORIZ	VERT	HORIZ	VERT	HORIZ	VERT	HORIZ	VERT	HORIZ	VERT	HORIZ	VERT	HORIZ	VERT	HORIZ
F	308	214/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	92/0	0/0	0/0	0/0
C	178	144/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	34/0	0/0	0/0	0/0
D	42	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	42/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT.	LOAD (LBS)	LC1	MAX	MEMB.	FORCE (LBS)	VERT.	LOAD (LBS)
FR-TO						FR-TO			
F-B	-384/0	0.0	0.0	0.04 (1)	7.81	B-E	0/0	0.00 (1)	
A-B	0/35	-91.8	-91.8	0.12 (1)	10.00				
B-C	0/0	-91.8	-91.8	0.49 (1)	10.00				
F-E	0/0	-18.5	-18.5	0.13 (4)	10.00				
E-D	0/0	-18.5	-18.5	0.17 (4)	10.00				

TOTAL WEIGHT = 2 X 19 = 37 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSI: TO=0.49/1.00 (B-C:1), BC=0.17/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.27 (B) (INPUT = 0.99)
JSI METAL = 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007910

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408313	J32	5	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:10:01 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns1I-CwSaqW3N8RhquCLsB/Bb6_yF_grcDKuGzkGI_PzLbra

Scale = 1:11.5

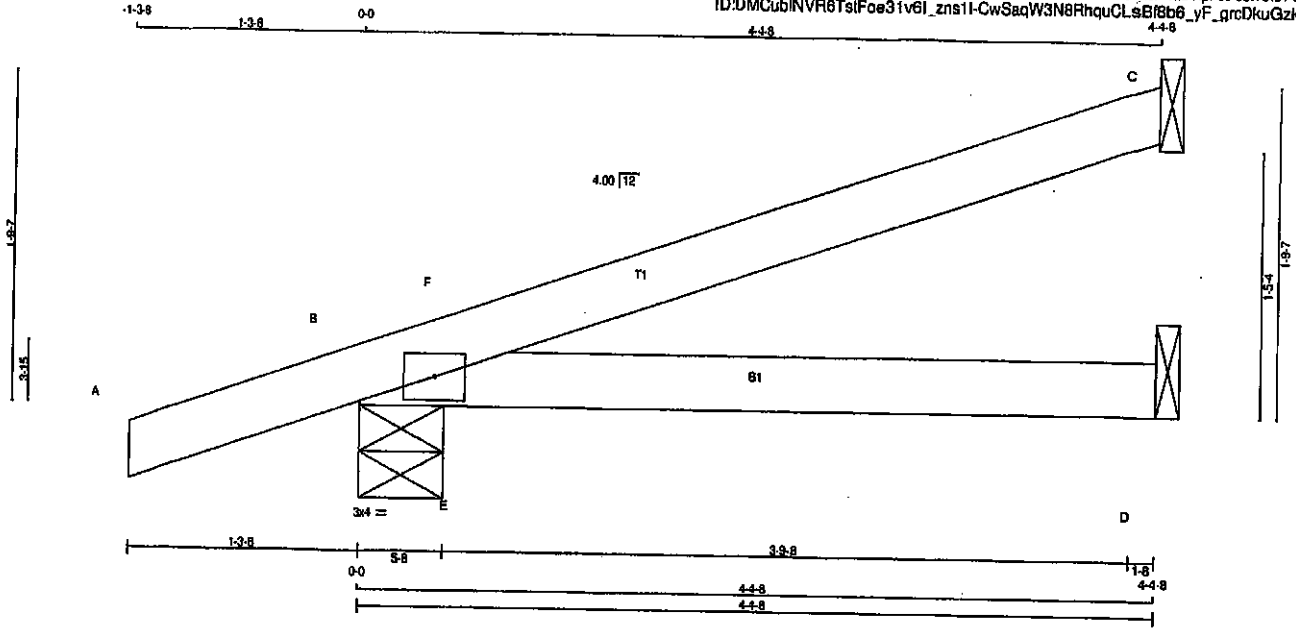

TOTAL WEIGHT = 5 X 12 = 60 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
B - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-1	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEAMS							
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX	
	VERT	HORZ	DOWN	HORZ			
C	174	0	174	0	0	1-8	
B	364	0	364	0	0	5-8	
D	68	0	68	0	0	1-8	

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
C	120	93/0	0/0	0/0	0/0	27/0	0/0
B	255	180/0	0/0	0/0	0/0	75/0	0/0
D	50	19/0	0/0	0/0	0/0	32/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO			FR-TO				
A-B	0 / 18	-91.8	-91.8	0.11 (1)	10.00	E-F	-194 / 7	0.00 (1)	
B-F	-14 / 0	-91.8	-91.8	0.05 (4)	8.25				
F-C	0 / 2	-91.8	-91.8	0.22 (1)	10.00				
B-E	0 / 0	-18.5	-18.5	0.17 (1)	10.00				
E-D	0 / 0	-18.5	-18.5	0.17 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/GC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCG 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.22/1.00 (C-F:1), BC=0.17/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SS=0.18/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1987 788 1987 1656

PLATE PLACEMENT TOL = 0.260 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.24 (B) (INPUT = 0.80)
JSI METAL = 0.07 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007912

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408313	J33	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:10:03 2020 Page 1
ID:DMCubINVR6TsiFoe31v6l_zns1i-9laLEC4eg2xY7WVEI4A3BP1d2TZyheNZQ2iO3izLbrY

Scale = 1:12.7

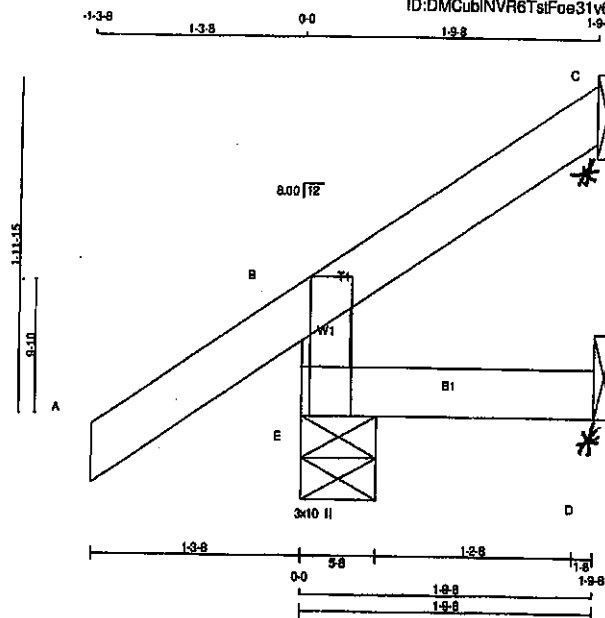

TOTAL WEIGHT = 3 X 7 = 21 lb

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
E	TMBM1+p	MT20	3.0	10.0	Edge 0.50

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
GROSS REACTION	GROSS REACTION	GROSS REACTION	GROSS REACTION	BRG	BRG	BRG	BRG
VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX
JT							
E	273	0	273	0	5-8	5-8	5-8
C	47	0	47	0	1-8	1-8	1-8
D	4	0	15	0	1-8	1-8	1-8

SEE MTEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 160 LBS FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 160 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	190	143 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0
C	32	25 / -18	0 / 0	0 / 0	0 / 0	7 / 0	0 / 0
D	4	0 / -11	0 / 0	0 / 0	0 / 0	11 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.26 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)	MAX	LC1
FR-TO		FROM	TO	FR-TO		FROM	TO
E-B	-244 / 0	0.0	0.0	0.05 (5)	7.61		
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00		
B-C	-20 / 0	-91.8	-91.8	0.09 (1)	6.25		
E-D	0 / 0	-18.5	-18.5	0.05 (5)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.05/1.00 (D-E:5), WB=0.00/1.00 (n/a:0), SSI=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1867 788

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.08 (E) (INPUT = 0.90)
JSI METAL = 0.08 (E) (INPUT = 1.00)



Structural component only
DWG# T-2007913

JOB NAME 408314	TRUSS NAME J60	QUANTITY 15	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

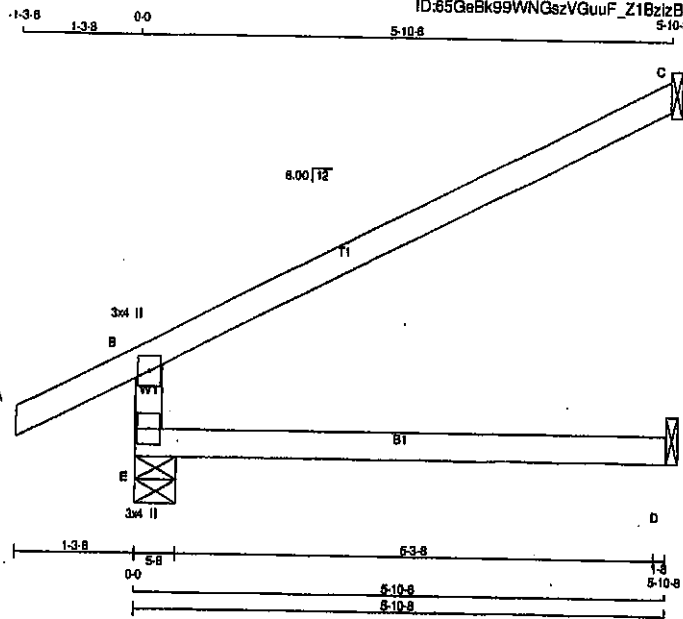

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	2x4	DRY	No.2
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
E	BMV+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
E	525	0	525	0	5-8
C	202	0	202	0	1-8
D	45	0	50	0	1-8

SEE MTEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST LCASE	MAX MIN COMPONENT REACTIONS	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
JT	COMBINED								
E	369	257/0	0/0	0/0	0/0	0/0	0/0	111/0	0/0
C	139	113/0	0/0	0/0	0/0	0/0	0/0	28/0	0/0
D	36	0/0	0/0	0/0	0/0	0/0	0/0	38/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)
FR-TO		FROM TO	CS1 (LC)	UNBRAC	LENGTH FR-TO
E-B	-461/0	0.0	0.0	0.13 (4)	7.81
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00
B-C	-30/0	-91.8	-91.8	0.54 (1)	6.25
E-D	0/0	-18.5	-18.5	0.13 (4)	10.00

TOTAL WEIGHT = 15 X 17 = 252 lb

DESIGN CRITERIA

SPECIFIED LOADS:		
TOP CH.	LL	= 25.8 PSF
	DL	= 8.0 PSF
BOT CH.	LL	= 0.0 PSF
	DL	= 7.4 PSF
TOTAL LOAD = 39.0 PSF		

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	384	1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.19 (E) (INPUT = 0.80)

JSI METAL= 0.13 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007949

JOB NAME 408314	TRUSS NAME J61	QUANTITY 5	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:32:09 2020 Page 1
ID:85GeBk89WNGszVGUuF_Z1BzizB3-KPidXc7OOT7PCIs6_Zz0x1yDz_7INLeKKLyZbRzLbWq

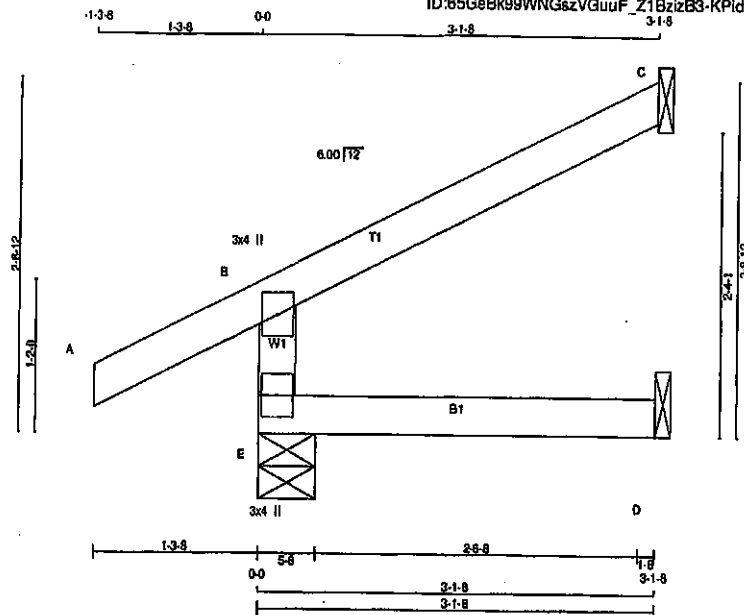

Scale = 1:16.3

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2		
A - C	2x4	DRY	No.2		
E - D	2x4	DRY	No.2		

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TRV+p	MT20	3.0	4.0		
E	BMV+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	336	0	336	0	0	5-8	5-8
C	108	0	108	0	0	1-8	1-8
D	25	0	28	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
E	236	169 / 0	0 / 0	0 / 0	0 / 0	68 / 0	0 / 0
C	74	60 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0
D	20	0 / 0	0 / 0	0 / 0	0 / 0	20 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED			WEBS			
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LOAD LC1	MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO		FR-TO			
E-B	-304 / 0	0.0	0.0	0.03 (4)	7.81			
A-B	0 / 28	-91.8	-91.8	0.13 (5)	10.00			
B-C	-16 / 0	-91.8	-91.8	0.15 (1)	6.25			
E-D	0 / 0	-18.5	-18.5	0.04 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 5 X 10 = 51 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.15/1.00 (B-C:1), BC=0.04/1.00 (D-E:4), WS=0.00/1.00 (N/A:2), SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788
	1907	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.13 (E) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007950

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408314	J62	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:32:10 2020 Page 1
ID:65GeBk99WNGszVGuuF_Z1BzizB3-obF?h809m7GqSRHYGUFTUJ1OSS6outZ?77zLbWp

Scale = 1:21.7

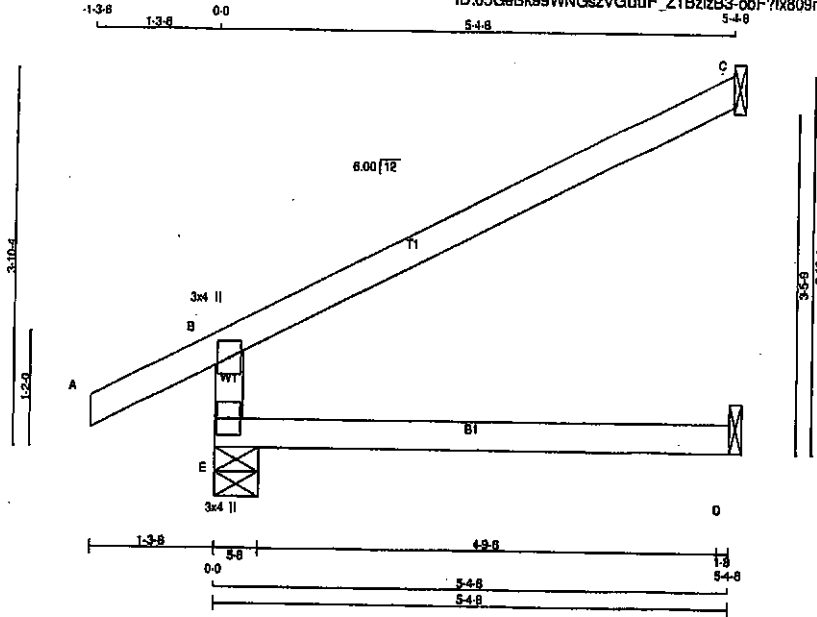

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

DESCR.
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	REQD BRG IN-SX
JT	VERT	DOWN	UP	
E	491	0	0	5-8
C	185	0	0	1-8
D	41	0	0	1-8

TOTAL WEIGHT = 2 X 16 = 31 lb (M)

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LOASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
E	344	241 / 0	0 / 0	0 / 0	0 / 0	103 / 0
C	127	103 / 0	0 / 0	0 / 0	0 / 0	24 / 0
D	33	0 / 0	0 / 0	0 / 0	0 / 0	33 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. VERT. LOAD (LC1)	MAX. HORIZ. LOAD (LC2)	MAX. UNBRACED LENGTH (FR-TO)	WEBS	MAX. FACTORED MEMB. FORCE (LBS)	MAX. HORIZ. LOAD (LC2)
FR-TO		FROM	TO					
E-B	-433 / 0	0.0	0.0	0.11 (4)	7.81			
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00			
B-C	-28 / 0	-91.8	-91.8	0.45 (1)	8.25			
E-D	0 / 0	-18.5	-18.5	0.11 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = 1/899 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.02")

CSI: TC=0.45/1.00 (B-C:1), BC=0.11/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.22/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1687

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.18 (E) (INPUT = 0.90)
JSI METAL= 0.12 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007951

JOB NAME 408314	TRUSS NAME J63	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 9 Oct 29 2019 MITek Industries, Inc. Thu Apr 30 08:32:11 2020 Page 1
ID:85GeBk99WNGszVGuuF_Z1BzizB3-GnpNyH9sw4F7Rb0T5_?U0S1azoporF61cfSggKzLbW0

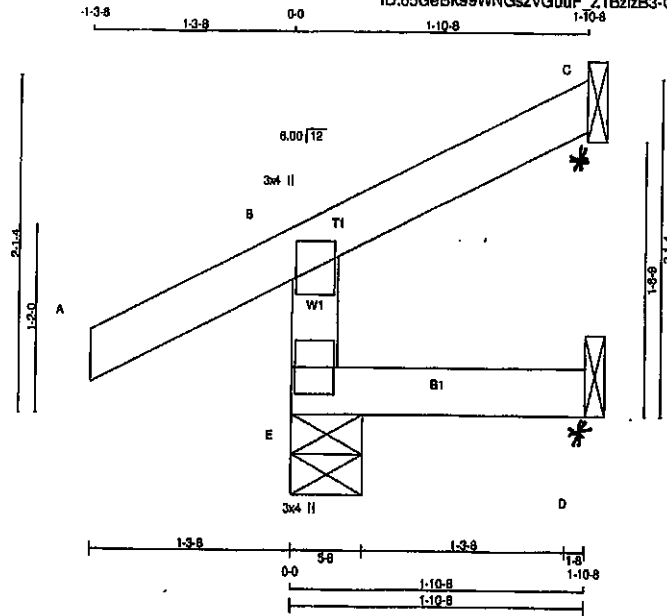

Scale = 1:13.2

TOTAL WEIGHT = 7 k

LUMBER

N. L. & A. RULES

CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DESIGN, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQ'D BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
E	273	0	273	0	5-8	5-8	5-8	5-8
C	50	0	50	0	1-8	1-8	1-8	1-8
D	8	0	17	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	190	143 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0
C	35	27 / -17	0 / 0	0 / 0	0 / 0	7 / 0	0 / 0
D	8	0 / -8	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

MEMB.	CHORDS		FACTORED		MAX. FACTORED	MEMB.	WEBS		MAX. FACTORED
	FORCE (LBS)	VERT. LOAD (PLF)	LC1 (PLF)	LC2 (PLF)			FORCE (LBS)	CS1 (LC)	
FR-TO									
E-B	-247 / 0	0.0	0.0	0.04 (5)	7.81				
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00				
B-C	-18 / 0	-91.8	-91.8	0.09 (1)	8.25				
E-D	0 / 0	-18.5	-18.5	0.04 (5)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.18")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.18")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5), WB=0.00/1.00 (N/A:0), SS=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1667 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.10 (5) (INPUT = 0.90)
JSI METAL = 0.07 (8) (INPUT = 1.00)




Structural component only
DWG# T-2007952

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408314	J64	6	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:32:13 2020 Page 1
ID:85GeBk99WNGszVGGuUF_Z1BzizB3-CAX8NzAuShVrhvAsDP1y5t8wLcUOJ9eKFznkCzLbWm

Scale = 1:18.0

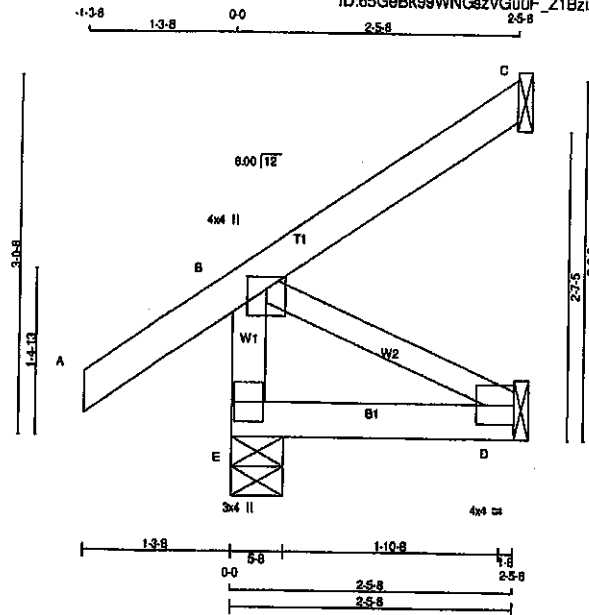

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	SPF	
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	
ALL WEBS 2x3 DRY No.2				SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
D	BMV1+1	MT20	4.0	4.0	2.00 Edge
E	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
E	280	0	0	280	0	0	0	5-8	5-8
C	113	0	113	0	0	1-8	1-8	1-8	1-8
D	22	0	24	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST LCASE		MAX/MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND
E	182	133/0	0/0	0/0	0/0
C	78	83/0	0/0	0/0	0/0
D	17	0/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
E-B	-239/0	0.0	0.0 0.02 (1)	B-D	0/0
A-B	0/35	-91.8	-91.8 0.13 (5)		
B-C	0/0	-91.8	-91.8 0.09 (1)		
E-D	0/0	-18.5	-18.5 0.03 (4)		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 8 X 11 = 87 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCO 2010, NBCO 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBCO 2018, CBCO 2012, ABC 2019
- PART 9 OF CBCO 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPC 2011, TPC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.13/1.00 (A-B-5), BC=0.03/1.00 (D-E-4), WB=0.00/1.00 (B-D-1), SS=0.09/1.00 (A-B-5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION	(PSI)	(PLI)
				MAX	MIN
MT20	818	354	1687	788	1967

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.80)
JSI METAL= 0.05 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007953

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408312	C1	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

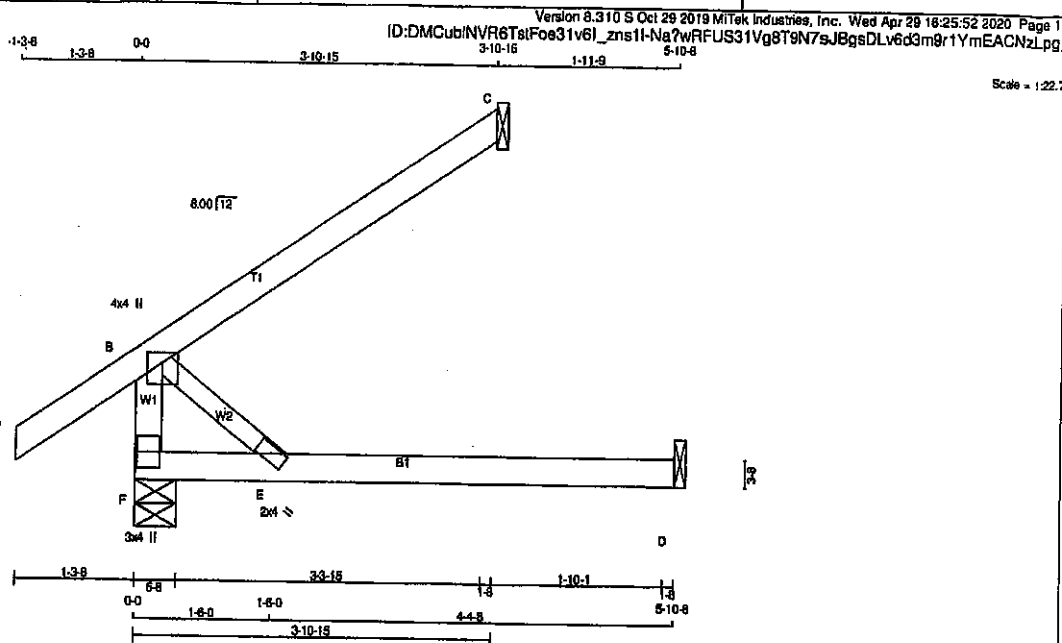

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS	2x4	DRY	No.2
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMVW+p	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECORD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
F	360	0	360	0	5-8	5-8
C	179	0	179	0	1-8	1-8
D	54	0	51	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE COMBINED		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM. LIVE	WIND			
F	254	170/0	0/0	0/0	83/0	0/0	0/0
C	124	100/0	0/0	0/0	23/0	0/0	0/0
D	43	0/0	0/0	0/0	43/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LGT (PLF)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		
F-B	305/0	0.0 0.0 0.33 (1)	7.81	0/0
A-B	0/85	-91.8 -91.8 0.12 (1)	10.00	0.00 (1)
B-C	0/0	-91.8 -91.8 0.24 (1)	10.00	
F-E	0/0	-18.5 -18.5 0.14 (4)	10.00	
E-D	0/0	-18.5 -18.5 0.19 (4)	10.00	

TOTAL WEIGHT = 2 X 17 = 34 k

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSI: TC=0.24/1.00 (B-C:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PS)	SECTION (PLI)
MT20	618	354	1887 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.89)
JSI METAL = 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007874

JOB NAME 408312	TRUSS NAME C2	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Wed Apr 28 16:25:54 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns1I-Jz7haxWaeIOOnIEHMHIAwJXE3KK74JHFzLpgh

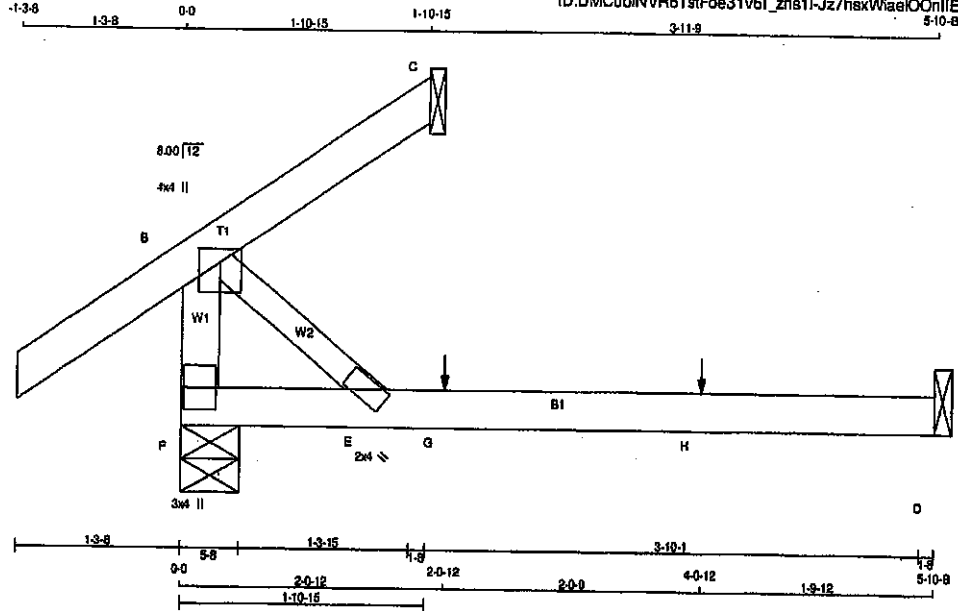

Scale = 1:16.2

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DESCR
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORIZ	DOWN	HORIZ		
F	313	0	313	0	5-8	5-8
C	42	0	42	0	1-8	1-8
D	54	0	61	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	222	144/0	0/0	0/0	0/0	77/0	0/0
C	29	24/0	0/0	0/0	0/0	8/0	0/0
D	43	0/0	0/0	0/0	0/0	43/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. FACTORED VERT. LOAD (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC)
FR-TO		FROM	TO		FR-TO		
F-B	-298/0	0.0	0.0	0.03 (1)	7.81	0-1	0/0
A-B	0/35	-91.8	-91.8	0.13 (1)	10.00		0.00 (1)
B-C	-25/0	-91.8	-91.8	0.12 (1)	6.25		
F-E	0/0	-18.5	-18.5	0.14 (4)	10.00		
E-G	0/0	-18.5	-18.5	0.19 (4)	10.00		
G-H	0/0	-18.5	-18.5	0.19 (4)	10.00		
H-D	0/0	-18.5	-18.5	0.19 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	2-0-12	1	1	---	BACK	VERT	TOTAL	---	C1
H	4-0-12	1	1	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 3 X 14 = 41 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIG 2011, TPIG 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSI TC-0.13/1.00 (A-B:1), BC-0.19/1.00 (D-E:4), WB-0.00/1.00 (B-E:1), SS-0.09/1.00 (B-C:1)

DOL LUMBER-0.98 NAIL-0.98 LB BEND-1.10
COMP-1.10 SHEAR-1.10 TENS-1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1867 788 1867 1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.18 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007875

JOB NAME 408312	TRUSS NAME C3	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

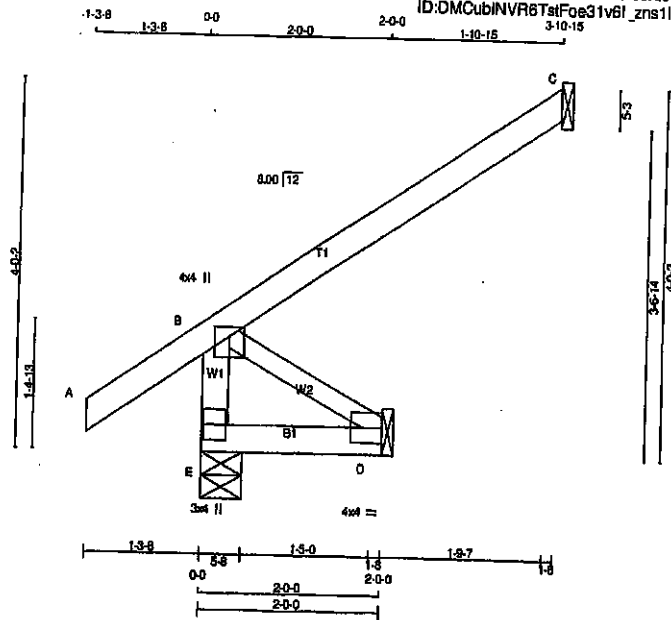

LUMBER				
N. L. G. A. RULES				
CHORDS		SIZE		LUMBER
E - B	2x4	DRY		No.2
A - C	2x4	DRY		No.2
E - D	2x4	DRY		No.2
ALL WEBS		2x3	DRY	No.2
DRY: SEASONED LUMBER.				

DESCR.
SPF
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	323	0	323	0	5-8	5-8
C	179	0	179	0	1-8	1-8
D	18	0	20	0	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
		SNOW	LIVE			
E	224	170/0	0/0	0/0	54/0	0/0
C	124	100/0	0/0	0/0	23/0	0/0
D	14	0/0	0/0	0/0	14/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CS1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)
FR-TO		FROM TO			FR-TO		
E-B	-305/0	0.0 0.0	0.03 (1)	7.81	B-D	0/0	0.00 (1)
A-B	0/35	-91.8 -91.8	0.13 (5)	10.00			
B-C	0/0	-91.8 -91.8	0.24 (1)	10.00			
E-D	0/0	-18.5 -18.5	0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 12 = 37 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2016, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (TL) = L/360 (0.18")

CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CS1: TC=0.24/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (B-D:1), SS1=0.12/1.00 (B-C:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1856

PLATE PLACEMENT TOL. = 0.260 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.21 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007876

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408313	C30	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 08:09:50 2020 Page 1					
ID:DMCubINVR6TstFoe31v6l_zns11-1olQWwUk3IC3W?12rR0Af_NXE5z8I9eRX6C5YzLbr					
Scale = 1:22.7					

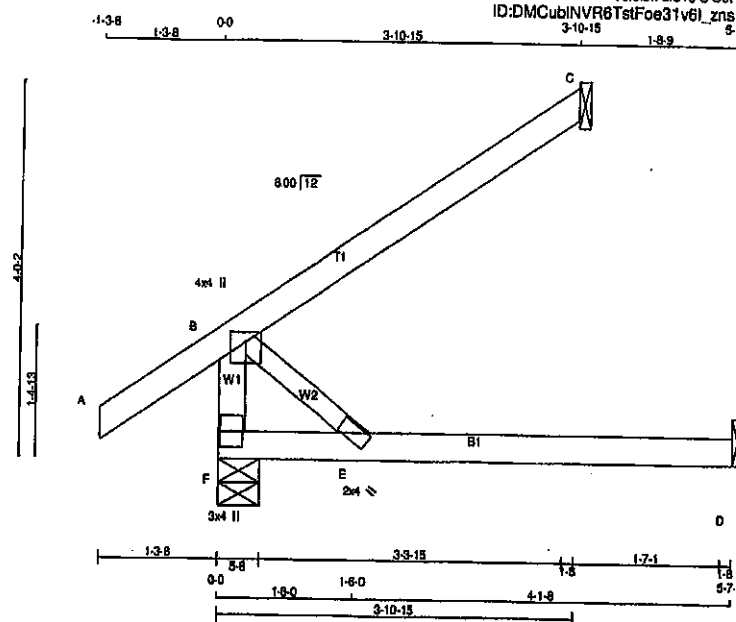

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	2x4	No.2	SPF
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMVW+p	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	RECORD
GROSS REACTION		GROSS REACTION		GROSS REACTION		BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
F	357	0	357	0	0	5-8	5-8
C	179	0	179	0	0	1-8	1-8
D	52	0	58	0	0	1-8	1-8

SEE MTEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	COMBINED	SNOW	LIVE	PERM. LIVE
F	252	170/0	0/0	0/0	0/0	82/0	0/0	252	170/0	0/0	0/0
C	124	100/0	0/0	0/0	0/0	23/0	0/0	124	100/0	0/0	0/0
D	42	0/0	0/0	0/0	0/0	42/0	0/0	42	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNSPACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE	VERT.	LOAD LC1	MEMB.	FORCE	VERT.	LOAD LC1
FR-TO	(LBS)	FROM	TO	FR-TO	(LBS)	FROM	TO
F-B	-305/0	0.0	0.0	0.03 (1)	7.81	B-E	0/0
A-B	0/35	-91.8	-91.8	0.12 (1)	10.00		
B-C	0/0	-91.8	-91.8	0.24 (1)	10.00		
F-E	0/0	-18.5	-18.5	0.13 (4)	10.00		
E-D	0/0	-18.5	-18.5	0.17 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 8.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 N.C.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2018
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPC 2011, TPC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.05")

CSI: TC=0.24/1.00 (B-C:1), BC=0.17/1.00 (D-E:4),
WB=0.00/1.00 (B-E:1), SS=0.12/1.00 (B-C:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX MIN MAX MIN
MT20	618	354	1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)

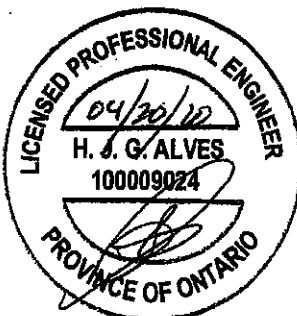


Structural component only
DWG# T-2007904

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408313	C31	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:08:52 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_znst1l-zBPBxRykFgY6lq979GUUF44lptnRdfxurbJARzLbrj

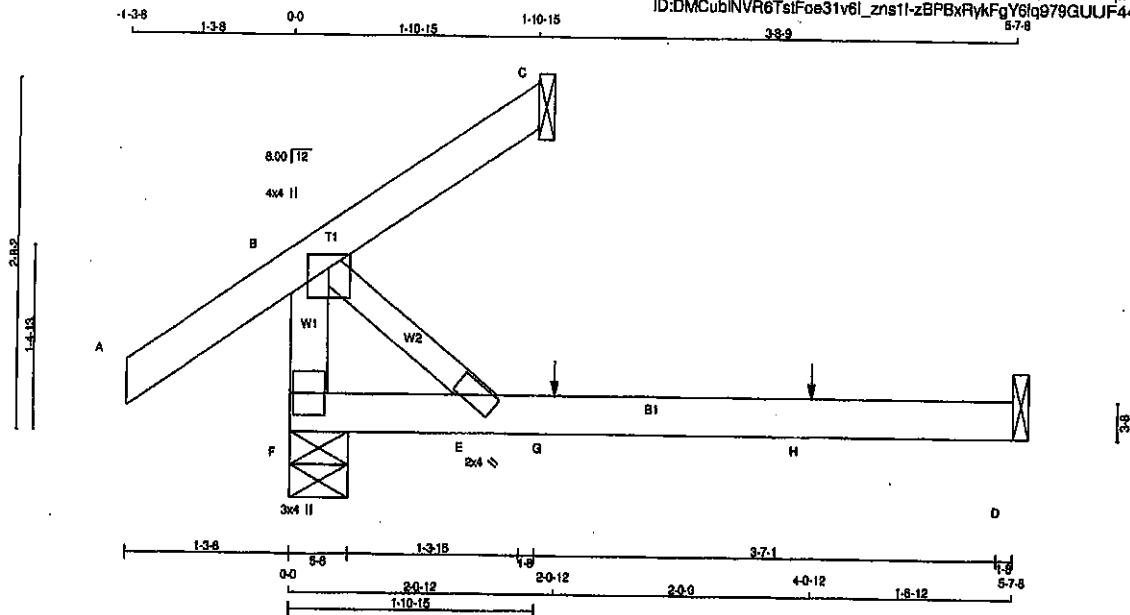

Scale = 1:16.2

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	2x4	DRY	SPF
F - B	2x4	DRY	SPF
A - C	2x4	DRY	SPF
F - D	2x4	DRY	SPF
ALL WEBS	2x3	DRY	SPF
DRY: SEASONED LUMBER.		No.2	

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMVW+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	JT	DOWN	IN-SX		IN-SX	
F	311	0	311	0	5-8	5-8	
C	42	0	42	0	1-8	1-8	
D	52	0	58	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		MAX/MIN COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM	LIVE	DEAD		SOIL	
F	220	144/0	0/0	0/0	0/0	75/0	0/0	0/0	
C	29	24/0	0/0	0/0	0/0	8/0	0/0	0/0	
D	42	0/0	0/0	0/0	0/0	42/0	0/0	0/0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (LBS)	MEMB.	FORCE (LBS)	MAX. (LBS)	CS1 (LBS)
FR-TO		FROM	TO	FR-TO			
F-B	-259/0	0.0	0.0	0.03 (1)	7.81	0/0	0.00 (1)
A-B	0/38	-91.8	-91.8	0.12 (1)	10.00		
B-C	-25/0	-91.8	-91.8	0.12 (1)	6.25		
F-E	0/0	-18.5	-18.5	0.13 (4)	10.00		
E-G	0/0	-18.5	-18.5	0.17 (4)	10.00		
G-H	0/0	-18.5	-18.5	0.17 (4)	10.00		
H-D	0/0	-18.5	-18.5	0.17 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)		LOC.		MAX.		FACE		DIR.		TYPE		HEEL		CONN.	
JT		LOC.		MAX.		MAX.		FRONT	VERT	TOTAL		HEEL		C1	
G	2-0-12	1	1	1	1	1	1	FRONT	VERT	TOTAL		HEEL		C1	
H	4-0-12	1	1	1	1	1	1	FRONT	VERT	TOTAL		HEEL		C1	

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 089-09, CSA 089-14
- TPC 2011, TPC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CS1: TC=0.12/1.00 (A-B:1), BC=0.17/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS1=0.09/1.00 (B-C:1)

DO1 LUMBER=0.99 NAIL=0.99 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES		PLATE GRIP(DRY) SHEAR		SECTION	
(PSI)	(PL)	(PSI)	(PL)	(PL)	(PL)
MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1887	788	1887

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP=0.18 (B) (INPUT = 0.90)
JSI METAL=0.05 (B) (INPUT = 1.00)

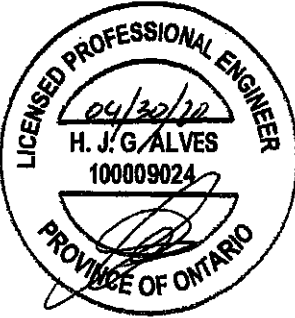

Structural component only
DWG# T-2007905

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408313	C32	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:09:53 2020 Page 1					
ID:DMCubINVR6TstFoe31v6l zns1l-RNzZ8nzMO_gzw_kJz7jnIcVNR9XL6v57VKatizLbri					
Scale = 1:15.8					

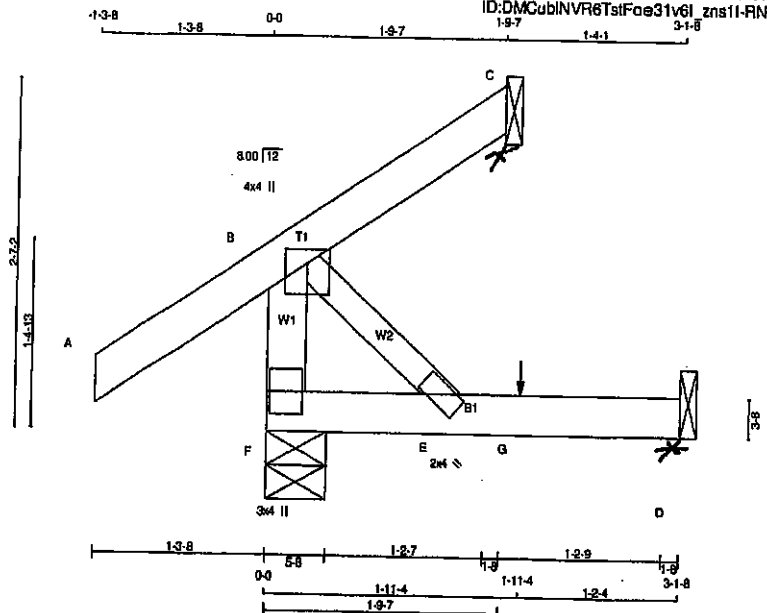

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS	2x4	DRY	No.2
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW+p	MT20	4.0	4.0 1.25 2.00
E	BMVW+p	MT20	2.0	4.0
F	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

DESCR.	SPF	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	RECORD BRG IN-SX
JT	SPF	VERT	DOWN	UP	DOWN
F	SPF	285	0	0	5-8
C	SPF	34	0	-39	1-8
D	SPF	29	0	32	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 140 LBS FACTORED UPLIFT

UNFACTORED REACTIONS	1ST LOASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM LIVE WIND DEAD SOIL
F	200	143 / 0 0 / 0 0 / 0 0 / 0 57 / 0 0 / 0
C	23	19 / -27 0 / 0 0 / 0 0 / 0 4 / 0 0 / 0
D	23	0 / 0 0 / 0 0 / 0 0 / 0 23 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LCI MAX	FACTORED MAX. UNBRAC LENGTH FR-TO	WEBS	MAX. FACTORED FORCE (LBS)	FACTORED MAX. CSI (LC)
FR-TO					MEMB.		
F-B	-258 / 0	0.0	0.0	0.03 (1)	7.81	B-E	0 / 0 0.00 (1)
A-B	0 / 35	-91.8	-91.8	0.14 (5)	10.00		
B-C	-27 / 0	-91.8	-91.8	0.13 (5)	6.25		
F-E	0 / 0	-18.5	-18.5	0.05 (4)	10.00		
E-G	0 / 0	-18.5	-18.5	0.05 (4)	10.00		
G-D	0 / 0	-18.5	-18.5	0.05 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	1-11-4	1	1	1	1	FRONT	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 10 = 21 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (A-B:5), BC=0.05/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	616 354	1887 788	1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.90)


JSI METAL= 0.05 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007906

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408313	C33	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:09:54 2020 Page 1
ID:DMCubINVR6TstF0e31v6l_zns1l-vaXxL7z_nHoqY7JWHhWyKV95JrUH4Z9EM94QFJzLbrh
1-9-7 1-10-8
Scale = 1:15.8

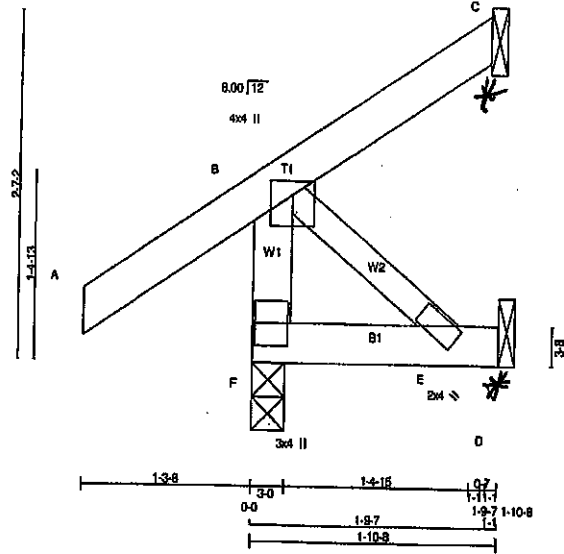

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
F - B	2x4 DRY	No.2
A - C	2x4 DRY	No.2
F - D	2x4 DRY	No.2

ALL WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

DESCR.
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
			IN-SX	IN-SX
JT	VERT	DOWN	HORIZ	UPLIFT
F	274	0	0	3-0
C	34	0	34	1-8
D	17	0	17	1-8

SEE MTEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 160 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

1ST CASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED SNOW LIVE PERM LIVE WIND DEAD SOIL
F	190 143/0 0/0 0/0 0/0 47/0 0/0
C	23 19/-27 0/0 0/0 0/0 4/0 0/0
D	14 0/0 0/0 0/0 0/0 14/0 0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX
FR-TO				FR-TO			
F-B	-258/0	0.0	0.03 (1)	B-E	0/0	0.00 (1)	
A-B	0/35	-91.8	-91.8 0.12 (1)				
B-C	-27/0	-91.8	-91.8 0.12 (1)				
F-E	0/0	-18.5	-18.5 0.02 (4)				
E-D	0/0	-18.5	-18.5 0.01 (4)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 9 = 18 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/D

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPG 2011, TPG 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.00")

CSH: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SSI=0.08/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PGI) (PLI) (PLJ)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.18 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)

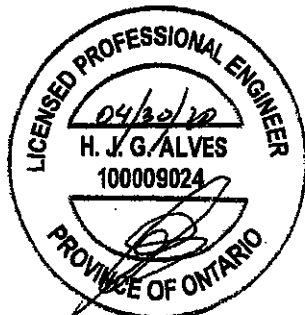


Structural component only
DWG# T-2007907

JOB NAME 408314	TRUSS NAME C60	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:32:00 2020 Page 1
ID:65GeBk99WNGszVGuuf_Z1BzizB3-5gfDfX0kWhdvMyAtu484g7M0mmGQPGSHbnSzLbWz

Scale = 1:17.5

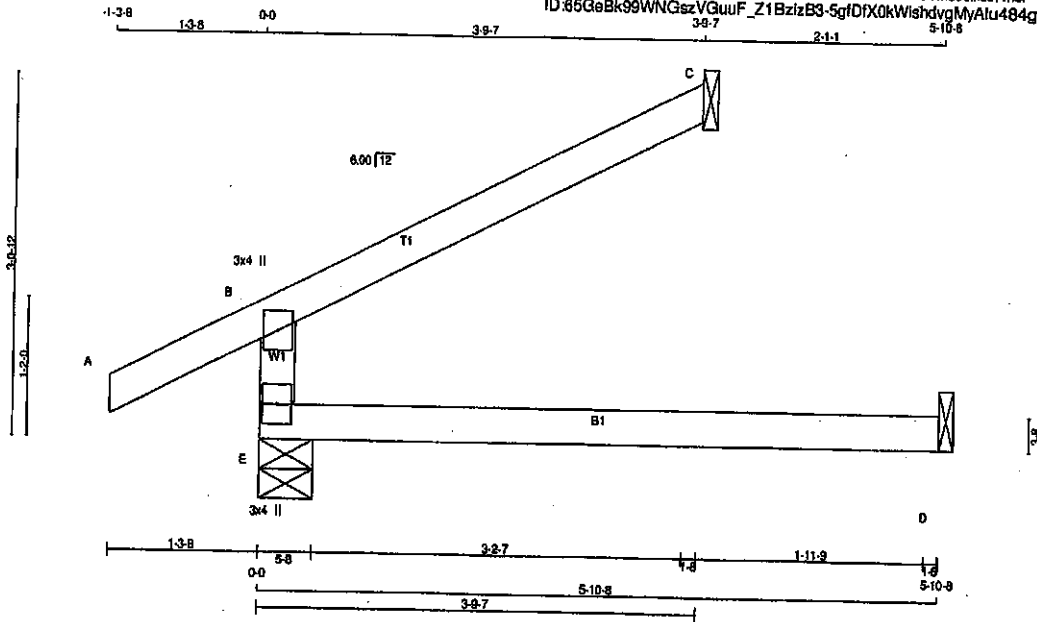

LUMBER			
N.L.G.A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
E	405	0	405	0	5-8	5-8		
C	130	0	130	0	1-8	1-8		
D	45	0	50	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE COMBINED		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM. LIVE	WIND			
E	235	190/0	0/0	0/0	0/0	98/0	0/0
C	90	73/0	0/0	0/0	0/0	17/0	0/0
D	36	0/0	0/0	0/0	0/0	36/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS		FACTORED	
	MAX. FORCE (LBS)	VERT. LOAD (PL)	MAX. LOAD (LC1)	MAX. GSI (LC)	MEMB. FORCE (LBS)	MAX. FORCE (LBS)	MAX. GSI (LC)	MAX. GSI (LC)
FR-TO								
E-B	-342/0	0.0	0.0	0.13 (4)	7.81			
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00			
B-C	-19/0	-91.8	-91.8	0.22 (1)	8.25			
E-D	0/0	-18.5	-18.5	0.13 (4)	10.00			

TOTAL WEIGHT = 4 X 14 = 57 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2018
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CSI: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (NA:0), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007943

JOB NAME 408314	TRUSS NAME C61	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 08:32:01 2020 Page 1
ID:85GeBk99WNGszVGuuf_Z1BzizB3-ZsDoss1NH?_YF3FYWtq7cLdsUmMvVigZV608JvzLbWY

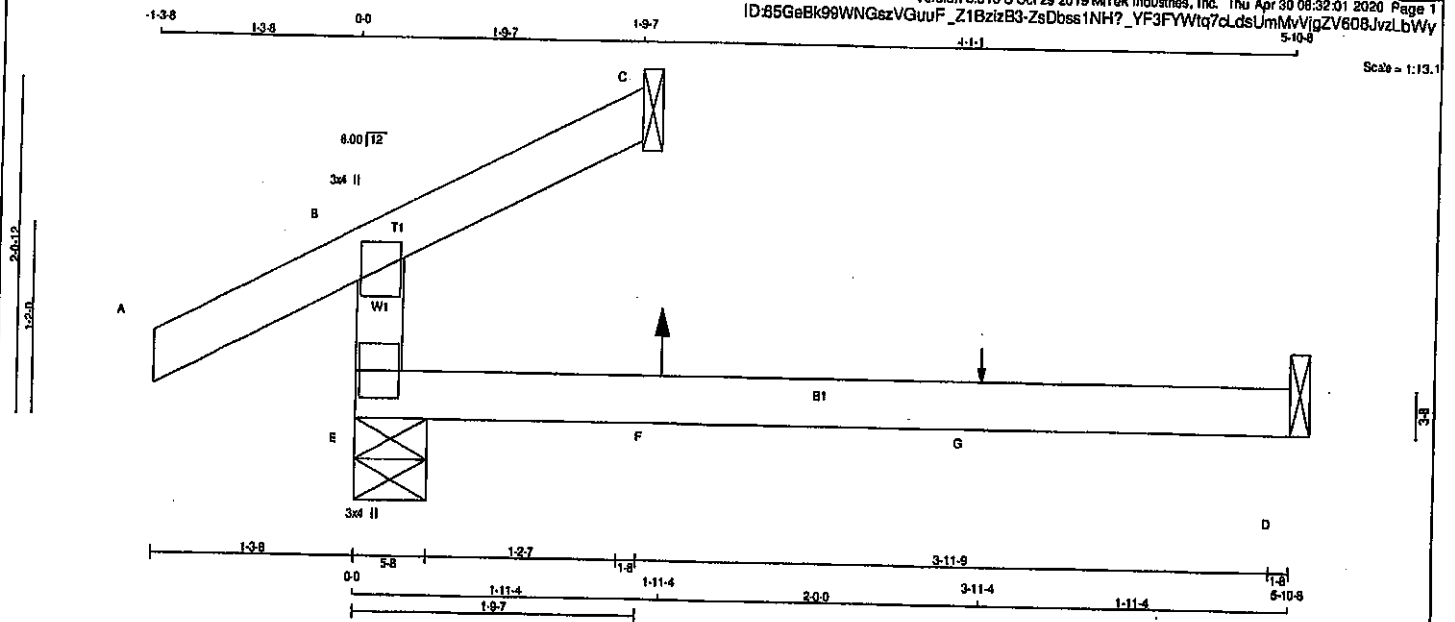

LUMBER			
N. L. & A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
E	284	0	284	0	5-8	5-8	5-8	5-8
C	63	0	63	0	1-8	1-8	1-8	1-8
D	44	0	52	0	1-8	1-8	1-8	1-8

SEE MTEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE COMBINED		MAX. MIN. COMPONENT REACTIONS		PERM. LIVE	WIND	DEAD	SOIL
	SNOW	LIVE	SNOW	LIVE				
E	200	137/0	0/0	0/0	0/0	0/0	82/0	0/0
C	48	21/0	0/0	0/0	0/0	0/0	25/0	0/0
D	35	0/3	0/0	0/0	0/0	0/0	37/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (7)

MEMB.	CHORDS		FACTORED		WEBS		MAX. FACTORED	
	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. LC1 (LC)	MAX. UNBRACED LENGTH (FT)	MAX. FORCE (LBS)	MAX. LC1 (LC)	MAX. FORCE (LBS)	MAX. LC1 (LC)
FR-TO								
E-B	-227/0	0.0	0.0	0.11 (4)	7.81			
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00			
B-C	-9/8	-91.8	-91.8	0.08 (4)	10.00			
E-F	0/0	-18.5	-18.5	0.14 (4)	10.00			
F-G	0/0	-18.5	-18.5	0.14 (4)	10.00			
G-D	0/0	-18.5	-18.5	0.14 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11-4	7	1	12	FRONT	VERT	TOTAL	-	C1
G	3-11-4	1	1	-	FRONT	VERT	TOTAL	-	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 4 X 12 = 48 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01")
ALLOWABLE DEFL. (TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.04")

CSI: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4), WB=0.08/1.00 (V-A:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=0.99 NAIL=0.99 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 768 1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.10 (5) (INPUT = 0.90)
JSI METAL = 0.08 (8) (INPUT = 1.00)



Structural component only
DWG# T-2007944

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408314	C62	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

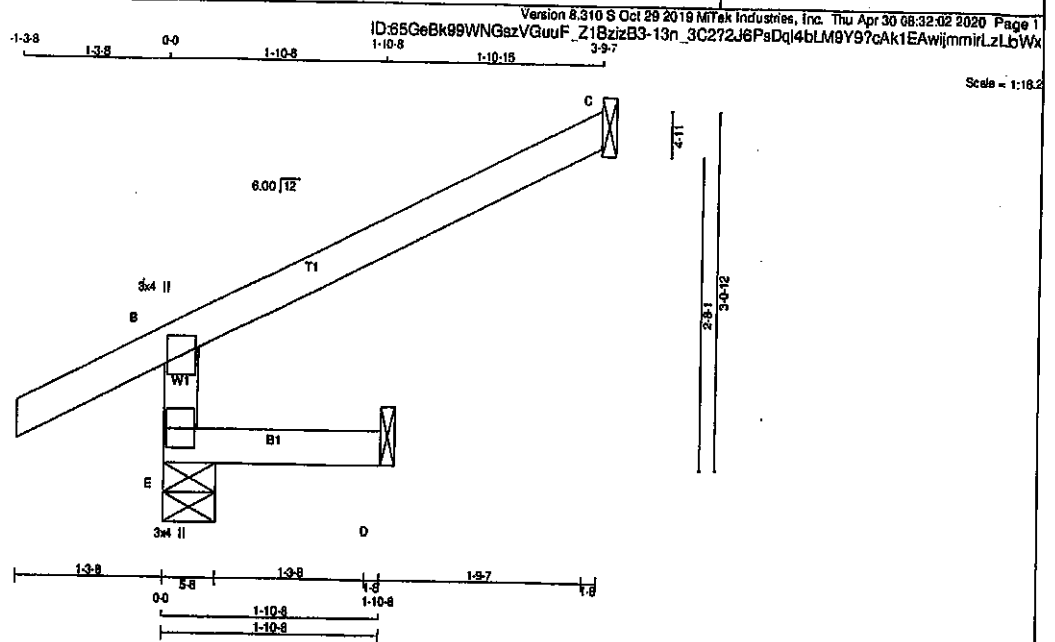

LUMBER			
N. L. Q. A. RULES	SIZE	LUMBER	
CHORDS	2x4	No.2	
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
E	381	0	381	0	5-8	5-8		
C	130	0	130	0	1-8	1-8		
D	16	0	17	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE		MAX/MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
E	250	180 / 0	0 / 0	0 / 0	0 / 0	60 / 0	0 / 0	
C	90	73 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0	
D	12	0 / 0	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		FACTORED		WEBS		FACTORED	
	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LO1 MAX	MAX. CSI (LC)	MEMB. UNBRAC LENGTH FR-TO	MAX. FORCE (LBS)	MAX. CSI (LC)	
FR-TO								
E-B	-342 / 0	0.0	0.0	0.01 (4)	7.81			
A-B	0 / 28	-91.8	-91.8	0.13 (5)	10.00			
B-C	-19 / 0	-91.8	-91.8	0.22 (1)	8.25			
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 4 X 10 = 38 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.18")
CALCULATED VERT. DEFL.(LL) = $L/899$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.18")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (A-B:0), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007945

JOB NAME 408314	TRUSS NAME C63	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:32:03 2020 Page 1
ID:55GeBk99WNGszVGuuF_Z1BzizB3-VFKMHY3dodEGUNPxdlsbhmC_a4xzd9ryQVFOzLbWw

Scale = 1:13.1

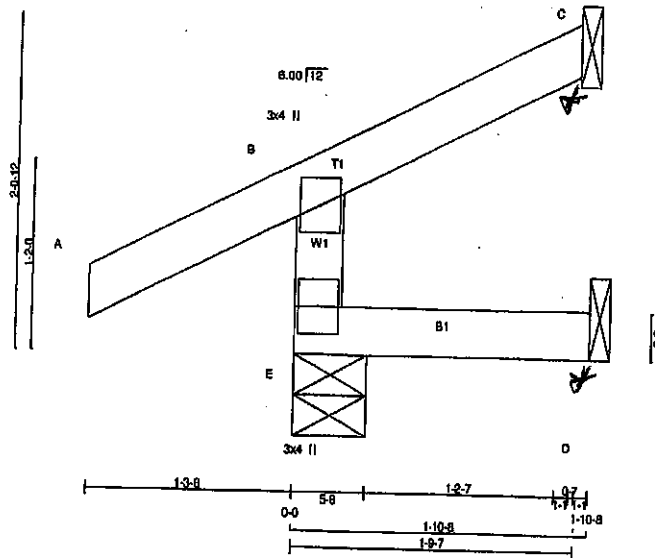

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS	2x4	DRY	No.2
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
E	271	271	0	IN-SX
C	45	45	0	5-8
D	8	17	0	1-8

SEE MITEK STANDARD DETAIL B97781H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
E	188	141 / 0	0 / 0	0 / 0	47 / 0	0 / 0
C	31	24 / -18	0 / 0	0 / 0	7 / 0	0 / 0
D	7	0 / -8	0 / 0	0 / 0	12 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PL)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
E-B	-244 / 0	0.0	0.0	0.04 (5)	7.81
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00
B-C	-17 / 0	-91.8	-91.8	0.09 (1)	6.25
E-D	0 / 0	-18.5	-18.5	0.04 (5)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 4 X 7 = 28 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/380$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/380$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5),
WB=0.00/1.00 (n/a:0), SS=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007946

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408314	C64	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:32:05 2020 Page 1
ID:65GeBk99WNGszVGuuF_Z1BzizB3-ReS6IE4KEUz(qZJl)u3nBnYUNmIRX18QI_MSqzLbWu

Scale = 1:12.4

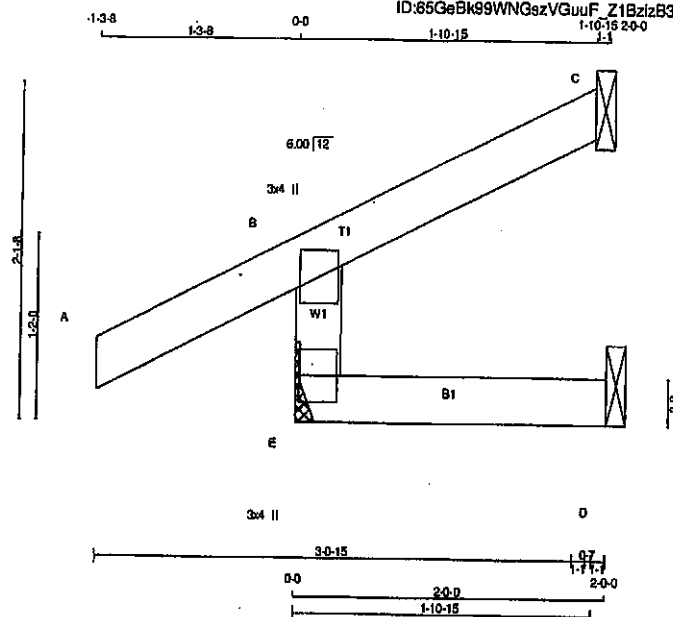

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
E	254	0	254	0	0	MECHANICAL
C	66	0	66	0	1-8	1-8
D	18	0	18	0	1-8	1-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	177	130 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0
C	48	37 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
D	13	0 / 0	0 / 0	0 / 0	0 / 0	13 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS				
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LOAD LC1	MAX. CSI (LC)	UNBRACED LENGTH	MEMB.	MAX. FORCE (LBS)	FACTORED MAX. CSI (LC)
FR-TO		FROM	TO			FR-TO		
E-B	-234 / 0	0.0	0.0	0.01 (4)	7.81			
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00			
B-C	-10 / 0	-91.8	-91.8	0.05 (1)	10.00			
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 7 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS1=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007947

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408314	C65	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 8 Oct 2019 MTEK Industries, Inc. Thu Apr 30 08:32:08 2020 Page 1					
ID:65GeBk89WNGszVGuuF_Z1BzizB3-vq0Uva5V5YcdLq8WJRPJOK1n5bA_vleNkv_6zLbWt					
Scale = 1:13.4					

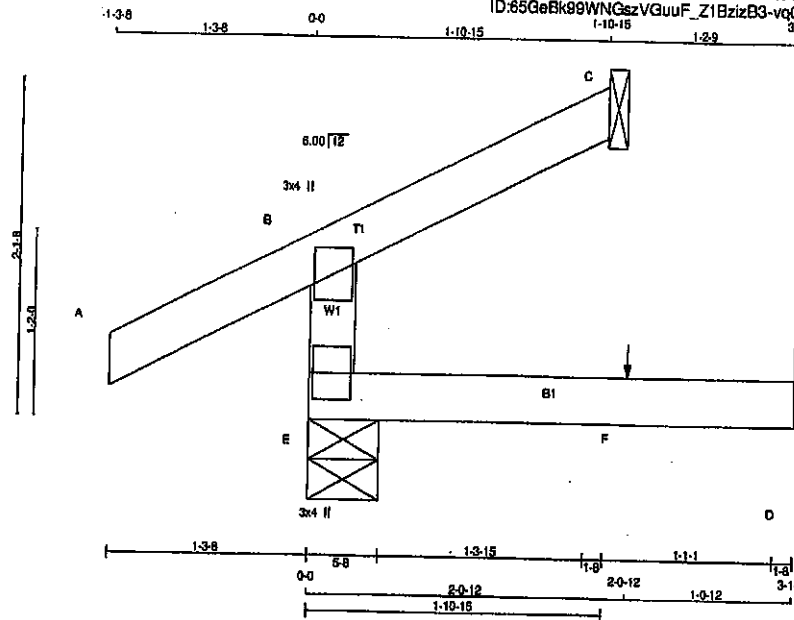

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY, SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ
E	268	0	268	0
C	66	0	66	0
D	25	0	25	0

SEE MTEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
	COMBINED						
E	187	130/0	0/0	0/0	0/0	67/0	0/0
C	46	37/0	0/0	0/0	0/0	9/0	0/0
D	20	0/0	0/0	0/0	0/0	20/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (6)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 MAX. (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LC1 MAX. (LC)	
FR-TO		FROM TO	LENGTH FR-TO				
E-B	-234/0	0.0	0.0 0.03 (4)	7.81			
A-B	0/28	-91.8	-91.8 0.13 (5)	10.00			
B-C	-10/0	-91.8	-91.8 0.06 (1)	10.00			
E-F	0/0	-18.5	-18.5 0.04 (4)	10.00			
F-D	0/0	-18.5	-18.5 0.04 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
F	2-0-12	1	1	1	BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 9 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TRC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CSI: TC=0.13/1.00 (A-B-S), BC=0.04/1.00 (D-E-4),
WB=0.00/1.00 (m-a-0), SSI=0.10/1.00 (A-B-S)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	818 354	1867 788	1967 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007948

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408312	V1	1	1	TRUSS DESC.		
Tamarack Roof Truss, Burlington						

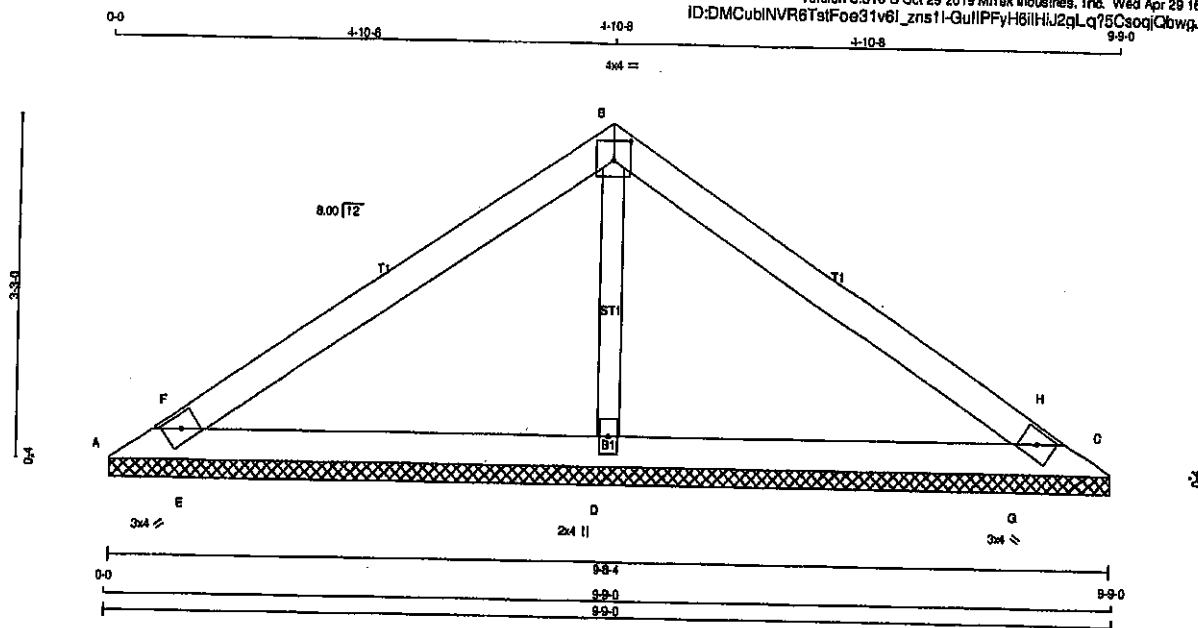

LUMBER			
N.L.G.A. RULES	CHORDS	SIZE	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
A - C	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY, SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TBM1-h	MT20	3.0	4.0	
B	TTW-p	MT20	4.0	4.0	2.25 2.00
C	TBM1-h	MT20	3.0	4.0	
D	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
A	34	0	34	0	0	9-8-4	9-8-4
C	34	0	34	0	0	9-8-4	9-8-4
D	1000	0	1000	0	0	9-8-4	9-8-4

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	24	15/0	0/0	0/0	0/0	9/0	0/0
C	24	15/0	0/0	0/0	0/0	9/0	0/0
D	707	466/0	0/0	0/0	0/0	241/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-F	0/412	-91.8 -91.8	0.16 (1)	D-B	-793/0	0.16 (1)	
F-B	0/401	-91.8 -91.8	0.28 (1)	E-F	-254/0	0.00 (1)	
B-H	0/401	-91.8 -91.8	0.28 (1)	G-H	-254/0	0.00 (1)	
H-C	0/412	-91.8 -91.8	0.16 (1)				
A-E	-377/0	-18.5 -18.5	0.19 (1)				6.25
E-D	-341/0	-18.5 -18.5	0.19 (1)				6.25
D-G	-341/0	-18.5 -18.5	0.19 (1)				6.25
G-C	-377/0	-18.5 -18.5	0.19 (1)				6.25

TOTAL WEIGHT = 25 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 N/C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSK TC=0.28/1.00 (B-H:1), BC=0.19/1.00 (D-G:1), WB=0.15/1.00 (B-D:1), SS=0.14/1.00 (C-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.87 (B) (INPUT = 0.90)
JSI METAL = 0.23 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007902

JOB NAME 408312	TRUSS NAME V2	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 29 16:28:31 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-k4sgdbzv0Q8KTdvYWKl4K2UqyxPonmWLAk4czLpg6

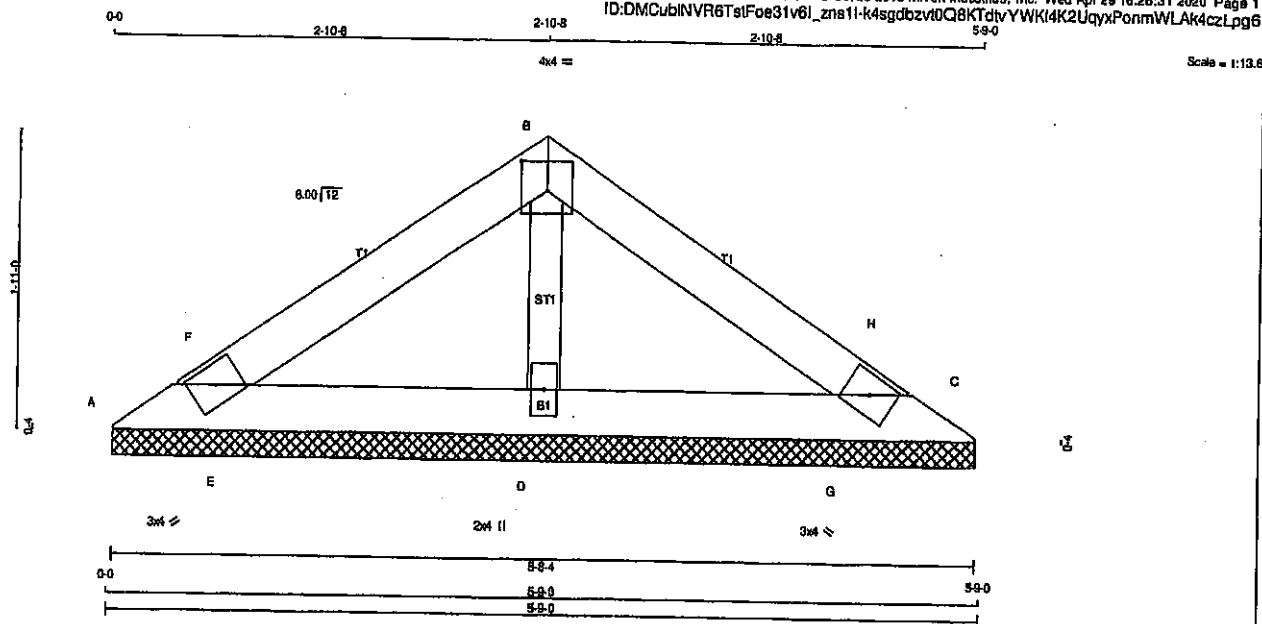

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
A - C	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0	
B	TTW-p	MT20	4.0	4.0	2.25 2.00
C	TBM1-h	MT20	3.0	4.0	
D	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION	VERT	GROSS REACTION	DOWN	BRG	BRG	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
A	80	0	80	0	0	5-8-4	5-8-4
C	80	0	80	0	0	5-8-4	5-8-4
D	487	0	487	0	0	5-8-4	5-8-4

UNFACTORED REACTIONS

1ST CASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	57	38/0	0/0	0/0	0/0	19/0	0/0
C	57	38/0	0/0	0/0	0/0	19/0	0/0
D	330	215/0	0/0	0/0	0/0	115/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.26 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. CGI (LC)	MEMB.	MAX. FORCE (LBS)	MAX. CGI (LC)	
FR-TO		FROM	TO	FR-TO		FROM	TO
A-F	0/114	-91.8	-91.8 0.03 (1)	10.00	D-B	-322/0	0.05 (1)
F-B	0/122	-91.8	-91.8 0.08 (1)	10.00	E-F	-115/0	0.00 (1)
B-H	0/122	-91.8	-91.8 0.08 (1)	10.00	G-H	-115/0	0.00 (1)
H-C	0/114	-91.8	-91.8 0.03 (1)	10.00			
A-E	-116/0	-18.5	-18.5 0.08 (1)	6.25			
E-D	-102/0	-18.5	-18.5 0.08 (1)	6.25			
D-G	-102/0	-18.5	-18.5 0.08 (1)	6.25			
G-C	-116/0	-18.5	-18.5 0.08 (1)	6.25			

TOTAL WEIGHT = 14 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.08/1.00 (B-H:1), SC=0.08/1.00 (D-E:1), WB=0.05/1.00 (B-D:1), SS=0.05/1.00 (B-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.27 (B) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007903

JOB NAME 408313	TRUSS NAME V30	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 08:10:39 2020 Page 1
ID:DMCubINVR6TstFos31v6I_zns1I-SEIyoVWDB6TRR2F9PeqVI7Wox_ov7susitTKCzLbr_

Scale = 1:34.6

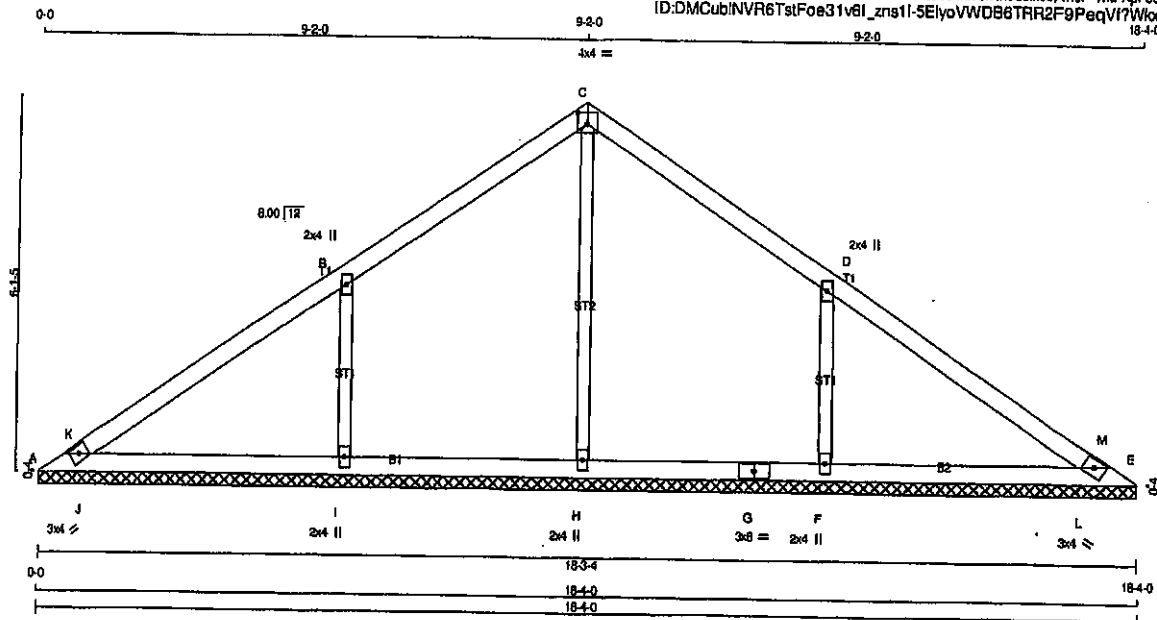

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
A - G	2x4	DRY	No.2
G - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TBM1-h	MT20	3.0	4.0
B	TBW+w	MT20	2.0	4.0
C	TTW-p	MT20	4.0	4.0 2.25 2.00
D	TBW+w	MT20	2.0	4.0
E	TBM1-h	MT20	3.0	4.0
F, H, I				
F	BMW1+w	MT20	2.0	4.0
G	BS-1	MT20	3.0	6.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
A	131	0	131	0	0	18-3/4 (8-3/8) 18-3/4	18-3/4 (8-3/8) 18-3/4	18-3/4	18-3/4
E	131	0	131	0	0	18-3/4 (8-3/8) 18-3/4	18-3/4 (8-3/8) 18-3/4	18-3/4	18-3/4
H	527	0	527	0	0	18-3/4 (8-3/8) 18-3/4	18-3/4 (8-3/8) 18-3/4	18-3/4	18-3/4
I	613	0	613	0	0	18-3/4 (8-3/8) 18-3/4	18-3/4 (8-3/8) 18-3/4	18-3/4	18-3/4
F	613	0	613	0	0	18-3/4 (8-3/8) 18-3/4	18-3/4 (8-3/8) 18-3/4	18-3/4	18-3/4

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE
A	92	83 / 0	0 / 0
E	92	83 / 0	0 / 0
H	375	232 / 0	0 / 0
I	433	288 / 0	0 / 0
F	433	288 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, H, I, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	MAX. CSI (LC)
FR-TO		FROM TO		FR-TO			
A-K	0 / 168	-91.8 -91.8 0.05 (4)	10.00	H-C	-493 / 0	0.28 (1)	
K-B	0 / 211	-91.8 -91.8 0.32 (1)	10.00	I-B	-475 / 0	0.10 (1)	
B-C	0 / 170	-91.8 -91.8 0.31 (1)	10.00	F-D	-475 / 0	0.10 (1)	
C-D	0 / 170	-91.8 -91.8 0.31 (1)	10.00	J-K	-151 / 6	0.00 (1)	
D-M	0 / 211	-91.8 -91.8 0.32 (1)	10.00	L-M	-151 / 6	0.00 (1)	
M-E	0 / 168	-91.8 -91.8 0.05 (4)	10.00				
A-J	-178 / 0	-18.5 -18.5 0.14 (1)	6.25				
J-I	-153 / 0	-18.5 -18.5 0.14 (1)	6.25				
I-H	-165 / 0	-18.5 -18.5 0.11 (1)	6.25				
H-G	-168 / 0	-18.5 -18.5 0.11 (1)	6.25				
G-F	-165 / 0	-18.5 -18.5 0.11 (1)	6.25				
F-L	-153 / 0	-18.5 -18.5 0.14 (1)	6.25				
L-E	-178 / 0	-18.5 -18.5 0.14 (1)	6.25				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.8 PSF
DL	= 6.0 PSF	
BOT CH.	LL	= 0.0 PSF
DL	= 7.4 PSF	
TOTAL LOAD	= 39.0 PSF	

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.32/1.00 (D-M:1), BC=0.14/1.00 (F-L:1), WB=0.28/1.00 (D-H:1), SS=0.18/1.00 (D-M:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	786	1987	1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.41 (C) (INPUT = 0.90)

JSI METAL= 0.24 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007939

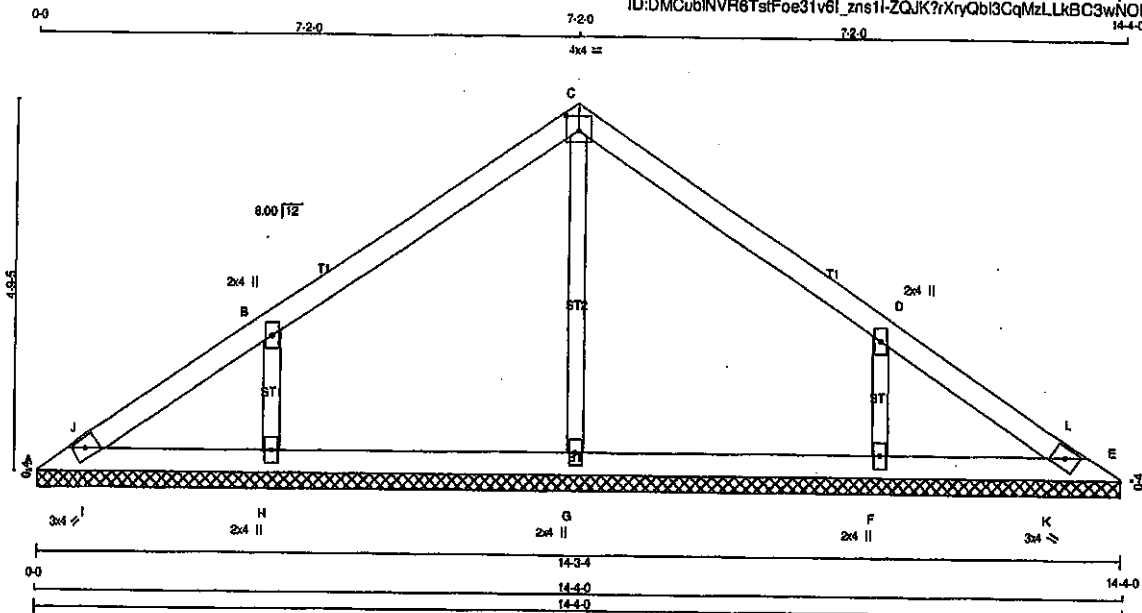

Scale = 1:27.3

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
A - E	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B	TMW+w	MT20	2.0	4.0		
C	TTW+p	MT20	4.0	4.0	2.25	2.00
D	TMW+w	MT20	2.0	4.0		
E	TBM1-h	MT20	3.0	4.0		
F, G, H	BMW1+w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
A	126	0	126	0	14-3-4	14-3-4
E	126	0	126	0	14-3-4	14-3-4
G	358	0	358	0	14-3-4	14-3-4
H	481	0	481	0	14-3-4	14-3-4
F	481	0	481	0	14-3-4	14-3-4

UNFACTORED REACTIONS

JT	1ST LOASE	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	89	81/0	0/0	0/0	0/0	28/0	0/0
E	89	81/0	0/0	0/0	0/0	28/0	0/0
G	286	151/0	0/0	0/0	0/0	105/0	0/0
H	339	229/0	0/0	0/0	0/0	111/0	0/0
F	339	229/0	0/0	0/0	0/0	111/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, G, H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS			WEBS		
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)
FR-TO				FR-TO		
A-J	-48/0	-91.8	-91.8 0.04 (1)	G-C	-287/0	0.09 (1)
J-B	0/12	-91.8	-91.8 0.21 (1)	H-B	-397/0	0.06 (1)
B-C	-32/3	-91.8	-91.8 0.21 (1)	F-D	-397/0	0.06 (1)
C-D	-32/3	-91.8	-91.8 0.21 (1)	I-J	-24/7	0.00 (1)
D-L	0/12	-91.8	-91.8 0.21 (1)	K-L	-24/7	0.00 (1)
L-E	-48/0	-91.8	-91.8 0.04 (1)			
A-I	-4/23	-18.5	-18.5 0.05 (4)			
I-H	-2/28	-18.5	-18.5 0.05 (4)			
H-G	-8/10	-18.5	-18.5 0.08 (4)			
G-F	-8/10	-18.5	-18.5 0.08 (4)			
F-K	-2/28	-18.5	-18.5 0.05 (4)			
K-E	-4/23	-18.5	-18.5 0.04 (1)			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.21/1.00 (D-L:1), BC=0.08/1.00 (G-H:4), WB=0.09/1.00 (C-G:1), SS=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(ORY)	SHEAR (PSI)	SECTION (PL)
MT20	618	354	1607 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.27 (B) (INPUT = 0.80)

JSI METAL= 0.20 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007940

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408313	V32	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:10:42 2020 Page 1	

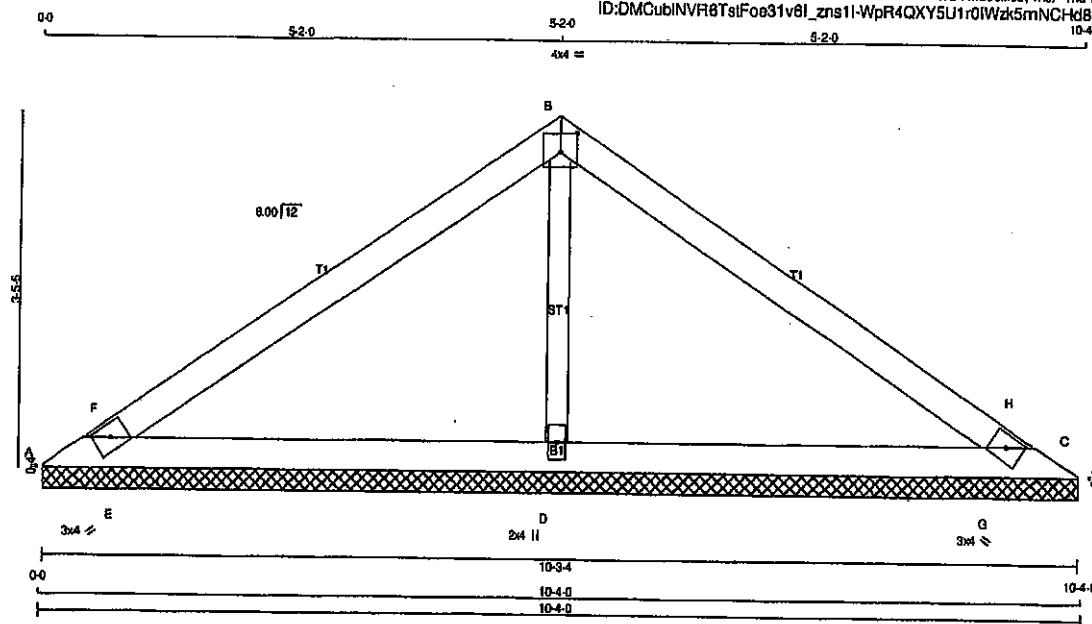

LUMBER	N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4 DRY	No.2	SPF		
B - C	2x4 DRY	No.2	SPF		
A - C	2x4 DRY	No.2	SPF		
ALL WEBS	2x3 DRY	No.2	SPF		
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B	TTW-p	MT20	4.0	4.0	2.25	2.00
C	TBM1-h	MT20	3.0	4.0		
D	BMW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
	VERT	HORZ	DOWN	HORZ
A	20	0	20	0
C	20	0	20	0
D	1091	0	1091	0

UNFACTORED REACTIONS							
JT	1ST CASE COMBINED	MAX/MIN COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	15	8/0	0/0	0/0	0/0	7/0	0/0
C	15	8/0	0/0	0/0	0/0	7/0	0/0
D	771	509/0	0/0	0/0	0/0	262/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	(PLF)	CSI (LC)	UNBRAC	MEMB.	FORCE	MAX
FR-TO	FROM	TO	LENGTH	FR-TO	TO	MEMB.	FORCE	MAX
A-F	0/470	-91.8	-91.8	0.18 (1)	10.00	D-B	-876/0	0.17 (1)
F-B	0/454	-91.8	-91.8	0.31 (1)	10.00	E-F	-279/0	0.00 (1)
B-H	0/454	-91.8	-91.8	0.31 (1)	10.00	G-H	-279/0	0.00 (1)
H-C	0/470	-91.8	-91.8	0.18 (1)	10.00			
A-E	-426/0	-18.5	-18.5	0.21 (1)	6.25			
E-D	-388/0	-18.5	-18.5	0.21 (1)	6.25			
D-G	-388/0	-18.5	-18.5	0.21 (1)	6.25			
G-C	-426/0	-18.5	-18.5	0.21 (1)	6.25			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TO=0.31/1.00 (B-H:1), BC=0.21/1.00 (D-G:1), WB=0.17/1.00 (B-D:1), SS=0.15/1.00 (C-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.74 (B) (INPUT = 0.90)
JSI METAL= 0.25 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007941

JOB NAME 408313	TRUSS NAME V33	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:10:43 2020 Page 1 ID:DMCubINVR6TstFoe31v6l_zns1l-?_TetZlFLztwYwslUrRphTFbCf3jPSdGRWSzzLbqw	

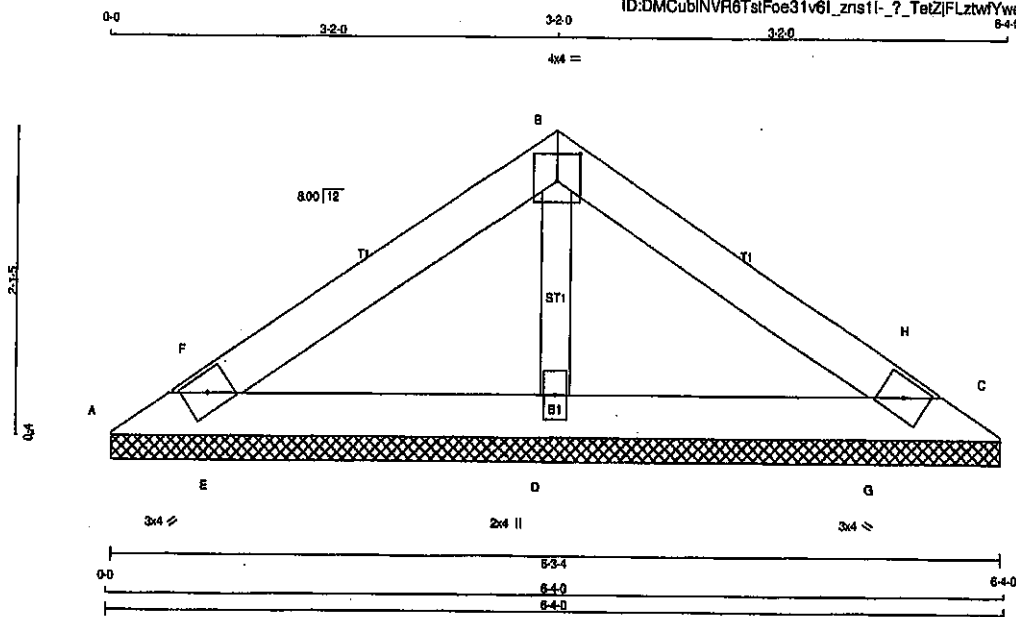

Scale = 1/4" = 1'-0"

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESOR.
CHORDS			
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
A - C	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TBM1-h	MT20	3.0	4.0	
B	TTW-p	MT20	4.0	4.0	2.25 2.00
C	TBM1-h	MT20	3.0	4.0	
D	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
A	79	0	79	0	0	0	0	8-3-4	8-3-4
C	79	0	79	0	0	0	0	8-3-4	8-3-4
D	534	0	534	0	0	0	0	8-3-4	8-3-4

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	58	37/0	0/0	0/0	0/0	0/0	18/0	0/0
C	58	37/0	0/0	0/0	0/0	0/0	18/0	0/0
D	378	247/0	0/0	0/0	0/0	0/0	131/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MEMB.	MAX. FORCE (LBS)	MAX. CSI (LC)	UNBRACED LENGTH FR-TO
FR-TO				FR-TO			
A-F	0/147	-91.8	-91.8 0.03 (1)	D-B	-381/0	0.08 (1)	10.00
F-B	0/164	-91.8	-91.8 0.10 (1)	E-F	-131/0	0.00 (1)	10.00
B-H	0/164	-91.8	-91.8 0.10 (1)	G-H	-131/0	0.00 (1)	10.00
H-C	0/147	-91.8	-91.8 0.03 (1)				
A-E	-146/0	-18.5	-18.5 0.09 (1)				6.25
E-D	-129/0	-18.5	-18.5 0.09 (1)				6.25
D-G	-129/0	-18.5	-18.5 0.09 (1)				6.25
G-C	-146/0	-18.5	-18.5 0.09 (1)				6.25

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.10/1.00 (B-H:1), BC=0.09/1.00 (D-G:1), WB=0.08/1.00 (B-D:1), SSI=0.07/1.00 (B-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.32 (B) (INPUT = 0.00)
JSI METAL = 0.11 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007942

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408312	PB1	5	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Wed Apr 28 16:26:02 2020 Page 1
ID:DMCubINVR6TatFee31v6I_zns11-4VciXgcj5mFL?vilyVX4zd4q83z6h1VrKHZozLpgZ

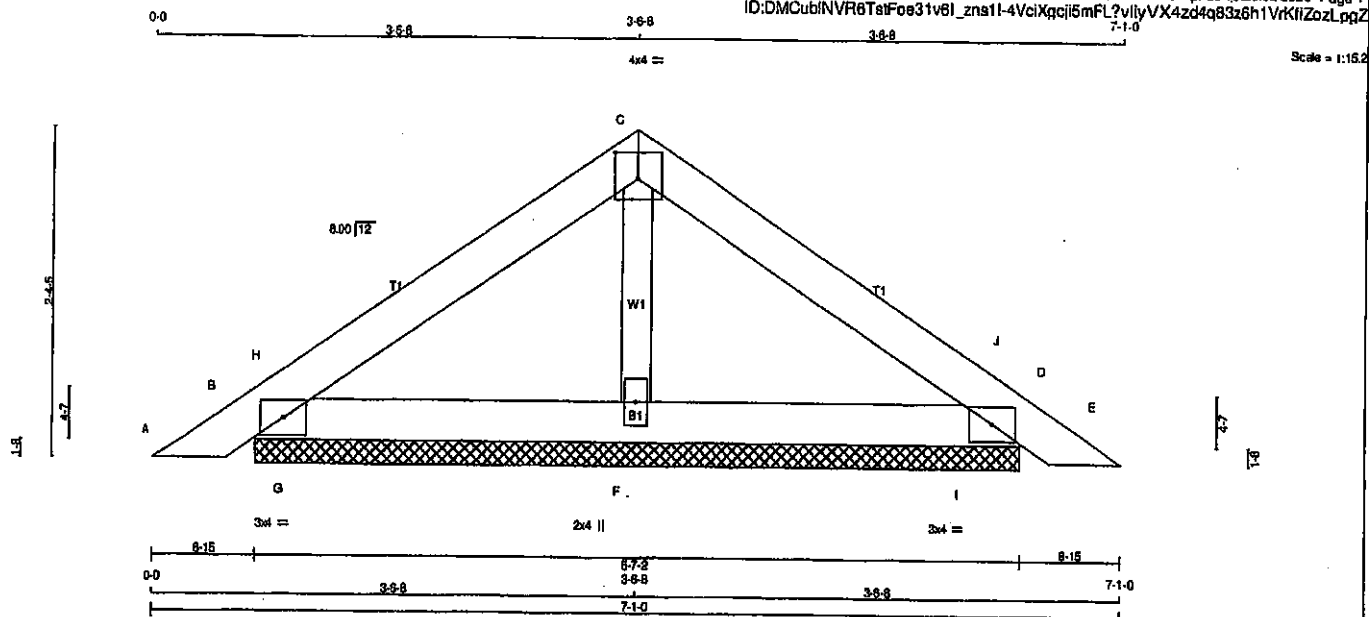

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
B - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TM81-H	MT20	3.0	4.0	
C	TM81-H	MT20	4.0	4.0	2.25 2.00
D	TM81-H	MT20	3.0	4.0	
F	BMW1-H	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

REARINGS							
	FACTORED	MAXIMUM FACTORED	INPUT	REQD			
	GROSS REACTION	GROSS REACTION	BRG	BRG			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
B	243	0	243	0	0	5-7-2	5-7-2
D	243	0	243	0	0	5-7-2	5-7-2
F	253	0	253	0	0	5-7-2	5-7-2

UNFACTORED REACTIONS

1ST CASE MAX/MIN COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
B	170	123 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0
D	170	123 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0
F	180	108 / 0	0 / 0	0 / 0	0 / 0	71 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 15	-91.8 -91.8	0.03 (1)	10.00	F-C	-122 / 0	0.02 (1)
B-H	-38 / 0	-91.8 -91.8	0.03 (1)	8.25	G-H	-202 / 0	0.00 (1)
H-C	-65 / 0	-91.8 -91.8	0.03 (1)	8.25	I-J	-202 / 0	0.00 (1)
C-J	-85 / 0	-91.8 -91.8	0.03 (1)	8.25			
J-D	-38 / 0	-91.8 -91.8	0.03 (1)	8.25			
D-E	0 / 15	-91.8 -91.8	0.03 (1)	10.00			
B-G	0 / 68	-18.5 -18.5	0.03 (1)	10.00			
G-F	0 / 68	-18.5 -18.5	0.03 (1)	10.00			
F-I	0 / 68	-18.5 -18.5	0.03 (1)	10.00			
I-D	0 / 68	-18.5 -18.5	0.03 (1)	10.00			

TOTAL WEIGHT = 5 X 17 = 87 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. GC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.08/1.00 (C-H:1), BC=0.09/1.00 (B-G:1), WB=0.02/1.00 (C-F:1), SS=0.15/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.21 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007881

JOB NAME 408312	TRUSS NAME PB2	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Wed Apr 29 16:26:03 2020 Page 1
ID:DMCubINVR6TstFoe31v6L_zns11-YiA410dLTPu6z9UUGg0mcAAEYYP8r8Ce4_OG5EzLpgY

Scale = 1:13.0

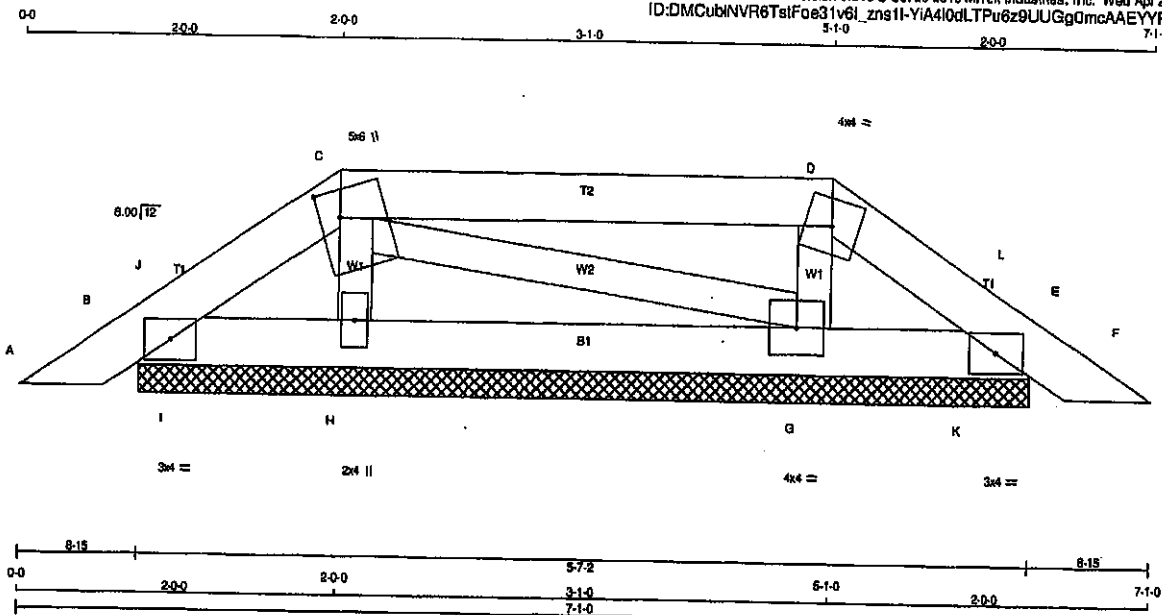

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
B - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-L	MT20	3.0	4.0	
C	TTWW+m	MT20	5.0	6.0	2.00 1.50
D	TTWW-m	MT20	4.0	4.0	
E	TMB1-L	MT20	3.0	4.0	
G	BMWW1-L	MT20	4.0	4.0	
H	BMWW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	JT	GROSS REACTION	BRG	BRG	BRG	BRG
B	149 0	B	149 0	5-7-2	5-7-2	5-7-2	5-7-2
E	144 0	E	144 0	5-7-2	5-7-2	5-7-2	5-7-2
H	218 0	H	218 0	5-7-2	5-7-2	5-7-2	5-7-2
G	228 0	G	228 0	5-7-2	5-7-2	5-7-2	5-7-2

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN COMPONENT REACTIONS
B	COMBINED	SNOW LIVE PERMLIVE WIND DEAD SOIL
E	103	81/0 0/0 0/0 0/0 22/0 0/0
H	100	78/0 0/0 0/0 0/0 22/0 0/0
G	155	85/0 0/0 0/0 0/0 60/0 0/0
H	162	101/0 0/0 0/0 0/0 61/0 0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS (B, E, H, G)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (LBS)	MEMB.	FORCE (LBS)	MAX. (LBS)	MAX. (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0/15	-91.8	-91.8 0.03 (1)	10.00	H-C	-158/0	0.02 (1)
B-J	-45/0	-91.8	-91.8 0.00 (4)	8.25	C-G	-9/0	0.00 (1)
J-C	-44/0	-91.8	-91.8 0.01 (1)	6.25	G-D	-165/0	0.02 (1)
C-D	-10/0	-91.8	-91.8 0.15 (1)	6.25	I-J	-55/0	0.00 (1)
D-L	-30/0	-91.8	-91.8 0.01 (1)	6.25	K-L	-56/0	0.00 (1)
L-E	-37/0	-91.8	-91.8 0.00 (4)	6.25			
E-F	0/15	-91.8	-91.8 0.03 (1)	10.00			
B-I	0/36	-18.5	-18.5 0.02 (1)	10.00			
I-H	0/36	-18.5	-18.5 0.03 (4)	10.00			
H-G	0/18	-18.5	-18.5 0.03 (4)	10.00			
G-K	0/29	-18.5	-18.5 0.03 (4)	10.00			
K-E	0/29	-18.5	-18.5 0.02 (1)	10.00			

TOTAL WEIGHT = 19 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.0 PSF
BOT CH. LL = 6.0 PSF
DL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.15/1.00 (C-D:1), GC=0.03/1.00 (H-I:4), WB=0.02/1.00 (D-G:1), SS=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(FSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1887 788 1887 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.12 (B) (INPUT = 0.90)
JSI METAL = 0.03 (H) (INPUT = 1.00)




Structural component only
DWG# T-2007882

JOB NAME 408313	TRUSS NAME PB30	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:10:04 2020 Page 1
ID:DMCubINVR6TstFoe31vbl_zns11-dv8jSY5GRM3Plg3RsnhlkcamqivCQ5BifVybkzLbrX

Scale = 1:14.6

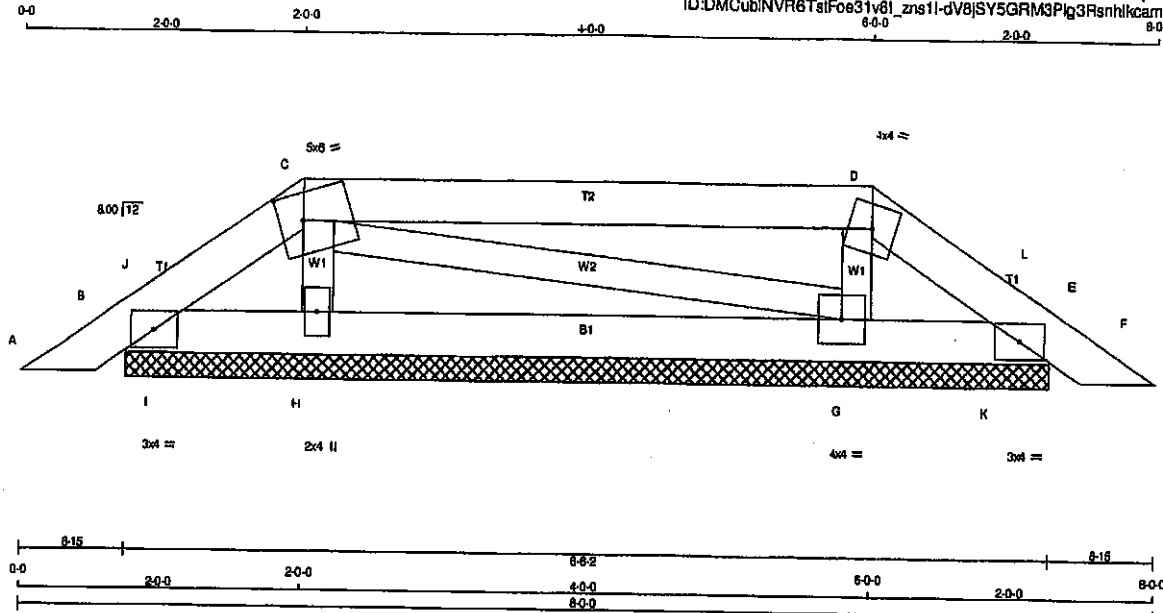

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
B - E	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	3.0	4.0	
C	TTWW-m	MT20	5.0	8.0	2.25 2.00
D	TTWW-m	MT20	4.0	4.0	
E	TMB1-I	MT20	3.0	4.0	
G	BMW1-I	MT20	4.0	4.0	
H	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	SPF	GROSS REACTION	VERT	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
B	146	0	146	0	0	6-6-2	6-6-2		
E	142	0	142	0	0	6-6-2	6-6-2		
H	273	0	273	0	0	6-6-2	6-6-2		
G	280	0	280	0	0	6-6-2	6-6-2		

UNFACTORED REACTIONS		1ST CASE		MAX./MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
B	100	82/0	0/0	0/0	18/0
E	97	80/0	0/0	0/0	17/0
H	195	117/0	0/0	0/0	77/0
G	199	121/0	0/0	0/0	78/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		FR-TO	
A-B	0/15	-91.8 -91.8 0.03 (1)	10.00	H-C	-197/0
B-J	-44/0	-91.8 -91.8 0.01 (4)	6.25	C-G	-6/0
J-C	-50/0	-91.8 -91.8 0.01 (1)	6.25	G-D	-202/0
C-D	-11/0	-91.8 -91.8 0.02 (1)	6.25	I-J	-86/0
D-L	-43/0	-91.8 -91.8 0.01 (1)	6.25	K-L	-67/0
L-E	-38/0	-91.8 -91.8 0.01 (4)	6.25		
E-F	0/15	-91.8 -91.8 0.03 (1)	10.00		
B-I	0/40	-18.5 -18.5 0.03 (1)	10.00		
I-H	0/40	-18.5 -18.5 0.05 (4)	10.00		
H-G	0/17	-18.5 -18.5 0.05 (4)	10.00		
G-K	0/34	-18.5 -18.5 0.05 (4)	10.00		
K-E	0/34	-18.5 -18.5 0.02 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.25/1.00 (C-D:1), BC=0.05/1.00 (H-I:4), WB=0.03/1.00 (D-G:1), SSI=0.14/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1967 1668

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 6.0 Deg.

JSI GRIP= 0.15 (D) (INPUT = 0.80)
JSI METAL= 0.04 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007914

JOB NAME 408313	TRUSS NAME PB31	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 08:10:05 2020 Page 1
ID:DMCubINVR8TstFoe31v8l_zns1i-5h15f6uBfBGMqedQVDXhQ6zdHFV9YVstMEV7AZLbrW

Scale = 1:14.6

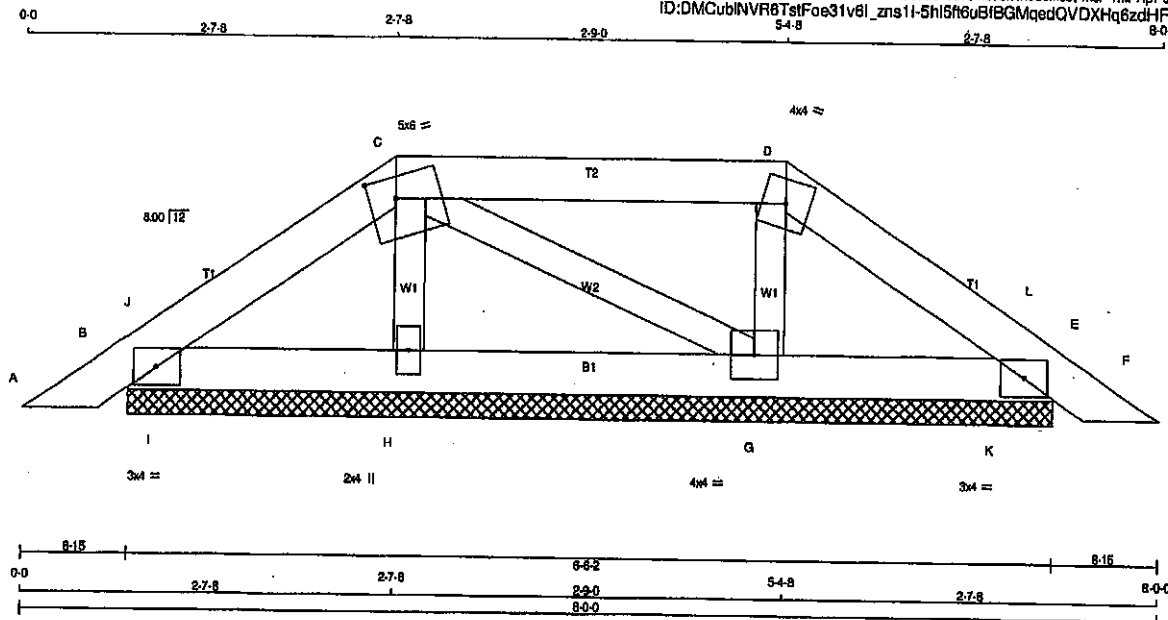

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
B - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT		REQD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	BRG	IN-SX	BRG	IN-SX
B	193	0	193	0	0	6-6-2	6-6-2	6-6-2	6-6-2
E	193	0	193	0	0	6-6-2	6-6-2	6-6-2	6-6-2
H	219	0	219	0	0	6-6-2	6-6-2	6-6-2	6-6-2
G	244	0	244	0	0	6-6-2	6-6-2	6-6-2	6-6-2

UNFACTORED REACTIONS

1ST LOASE		MAX. MIN. COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	COMBINED	SNOW	LIVE	PERM. LIVE
B	135	100/0	0/0	0/0	0/0	35/0	0/0	135	100/0	0/0	0/0
E	128	94/0	0/0	0/0	0/0	34/0	0/0	128	94/0	0/0	0/0
H	155	98/0	0/0	0/0	0/0	59/0	0/0	155	98/0	0/0	0/0
G	173	111/0	0/0	0/0	0/0	63/0	0/0	173	111/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD LC1	MAX. (PLF)	MEMB.	FORCE (LBS)	VERT. LOAD LC1	MAX. (PLF)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0/15	-91.8	-91.8 0.03 (1)	10.00	H-C	-157/0	0.02 (1)
B-J	-58/0	-91.8	-91.8 0.00 (1)	8.25	C-G	-174/0	0.02 (1)
J-C	-60/0	-91.8	-91.8 0.04 (1)	8.25	G-D	-174/0	0.02 (1)
C-D	-21/0	-91.8	-91.8 0.12 (1)	8.25	D-L	-89/0	0.00 (1)
D-L	-43/0	-91.8	-91.8 0.04 (1)	8.25	K-L	-91/0	0.00 (1)
L-E	-40/0	-91.8	-91.8 0.00 (1)	6.25			
E-F	0/15	-91.8	-91.8 0.03 (1)	10.00			
B-I	0/49	-18.5	-18.5 0.04 (1)	10.00			
I-H	0/49	-18.5	-18.5 0.04 (1)	10.00			
H-G	0/37	-18.5	-18.5 0.03 (4)	10.00			
G-K	0/35	-18.5	-18.5 0.04 (1)	10.00			
K-E	0/35	-18.5	-18.5 0.04 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (D-C:1), BC=0.04/1.00 (B-1), WB=0.02/1.00 (D-G:1), SSI=0.10/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSD) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1937 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.15 (B) (INPUT = 0.90)
JSI METAL = 0.03 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007915

JOB NAME 408313	TRUSS NAME PB32	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:10:07 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns11-14ps4Z78jHR_c7o0XwF7MFCKO4wzdRN8LgicC3zLbrU
Scale = 1:9.5

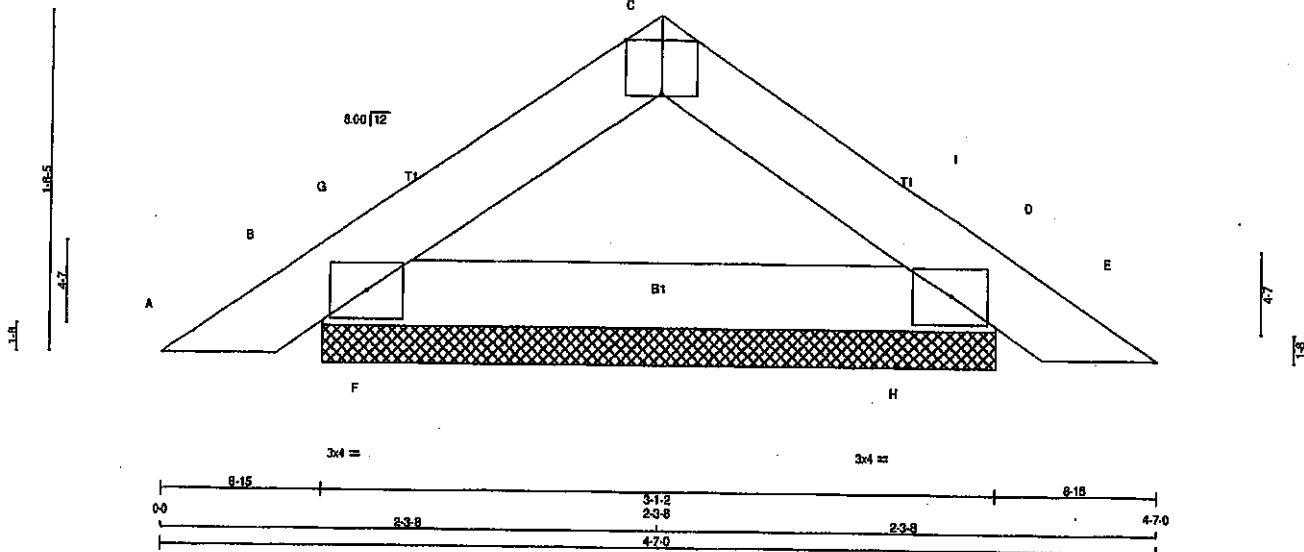

LUMBER				DESCR.	
N.L.G.A. RULES	CHORDS	SIZE	LUMBER	SPF	SPF
A - C	2x4	DRY	No.2	SPF	SPF
C - E	2x4	DRY	No.2	SPF	SPF
B - D	2x4	DRY	No.2	SPF	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	3.0	4.0	
C	TT-p	MT20	3.0	4.0	Edge 2.00
D	TMB1-I	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT		REQD	
JT	VERT	HORIZ	DOWN	HORIZ	UPLIFT	BRG	BRG
B	231	0	231	0	0	3-1-2	3-1-2
D	231	0	231	0	0	3-1-2	3-1-2

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM	LIVE	WIND	DEAD
B	163	113/0	0/0	0/0	0/0	0/0	49/0
D	163	113/0	0/0	0/0	0/0	0/0	49/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/15	-91.8 -91.8	0.03 (1)	10.00	F-G	0/41	0.00 (1)
B-G	-189/0	-91.8 -91.8	0.03 (4)	6.25	H-I	0/41	0.00 (1)
G-C	-119/0	-91.8 -91.8	0.04 (1)	6.25			
C-I	-119/0	-91.8 -91.8	0.04 (1)	6.25			
I-D	-169/0	-91.8 -91.8	0.03 (4)	6.25			
D-E	0/15	-91.8 -91.8	0.03 (1)	10.00			
B-F	0/105	-18.5 -18.5	0.02 (1)	10.00			
F-H	0/105	-18.5 -18.5	0.04 (1)	10.00			
H-D	0/105	-18.5 -18.5	0.02 (1)	10.00			

TOTAL WEIGHT = 2 X 10 = 20 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.04/1.00 (C-I), BC=0.04/1.00 (F-H), WB=0.00/1.00 (F-G), SS=0.05/1.00 (C-G)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 6.0 Deg.


JSI GRIP = 0.16 (D) (INPUT = 0.80)
JSI METAL = 0.05 (B) (INPUT = 1.00)

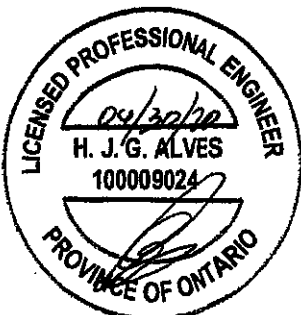

Structural component only
DWG# T-2007916

JOB NAME 408313	TRUSS NAME PB33	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 9.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 08:10:08 2020 Page 1
ID:DMCubINVR6TstFoe31v6L_zns1I-VGNEV8mUaZrDHNC5dmEuSKVFUGZMuVlaKT9kVzLbrT

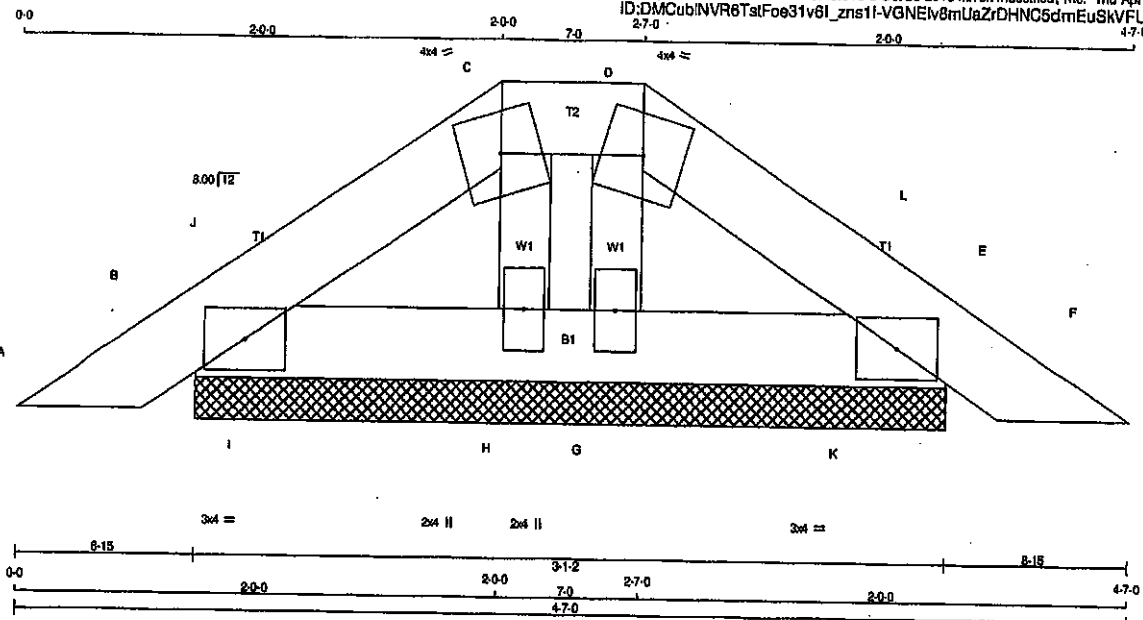

Scale = 1/8" = 1'-0"

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - E	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX		REQD BRG IN-SX	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
B	140	0	140	0	0	3-1-2	3-1-2	3-1-2	3-1-2
E	140	0	140	0	0	3-1-2	3-1-2	3-1-2	3-1-2
G	91	0	91	0	0	3-1-2	3-1-2	3-1-2	3-1-2
H	91	0	91	0	0	3-1-2	3-1-2	3-1-2	3-1-2

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	DEAD	SOIL
B	98	72/0	0/0	0/0	0/0	26/0	0/0	0/0	0/0
E	98	72/0	0/0	0/0	0/0	26/0	0/0	0/0	0/0
G	65	41/0	0/0	0/0	0/0	23/0	0/0	0/0	0/0
H	65	41/0	0/0	0/0	0/0	23/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, G, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FORCE (LBS)	MAX. CSI (LC)	MAX. CSI (LC)
FR-TO		FROM TO		FR-TO			
A-B	0/15	-91.8 -91.8 0.03 (1)	10.00	G-D	-59/0	0.01 (1)	
B-J	-29/0	-91.8 -91.8 0.00 (4)	8.25	H-C	-59/0	0.01 (1)	
J-C	-22/0	-91.8 -91.8 0.02 (1)	6.25	I-J	-47/0	0.00 (1)	
C-D	-13/0	-91.8 -91.8 0.01 (1)	6.25	K-L	-47/0	0.00 (1)	
D-L	-22/0	-91.8 -91.8 0.02 (1)	6.25				
L-E	-29/0	-91.8 -91.8 0.00 (4)	8.25				
E-F	0/15	-91.8 -91.8 0.03 (1)	10.00				
B-I	0/19	-18.5 -18.5 0.02 (1)	10.00				
I-H	0/19	-18.5 -18.5 0.02 (1)	10.00				
H-G	0/13	-18.5 -18.5 0.01 (1)	10.00				
G-K	0/19	-18.5 -18.5 0.02 (1)	10.00				
K-E	0/19	-18.5 -18.5 0.02 (1)	10.00				

TOTAL WEIGHT = 11 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPO 2011, TPO 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 3.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.03/1.00 (E-F:1), SC=0.02/1.00 (G-K:1), WB=0.01/1.00 (D-G:1), SS=0.04/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1667 788 1897 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.11 (B) (INPUT = 0.90)

JSI METAL= 0.02 (B) (INPUT = 1.00)

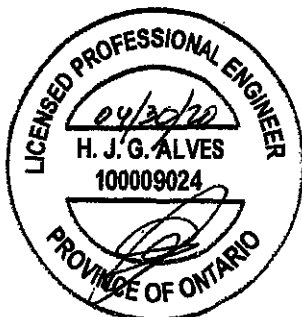

Structural component only
DWG# T-2007917

LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:

- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options Information on p. 126.




Double-Shear
Nailing
Top View




Double-Shear
Nailing
Side View;
Do not
bend tab




Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,580

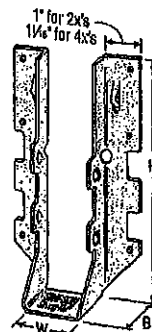


✓ LUS28




LU26L

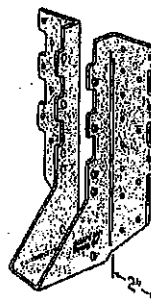

✓ HUS210
(HUS26, HUS28,
and HHUS similar)





✓ HGUS28-2



✓ HHUS210-2

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

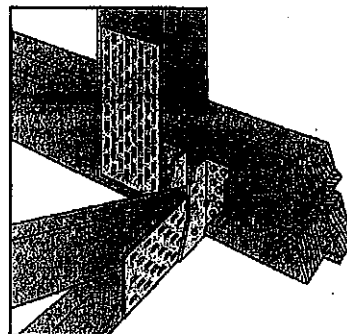

LJS26DS

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options Information on pp. 125-127.


HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
$W < 2"$	Bevel or square cut	0.62 of table value	0.46 of table value
$2" < W < 6"$	Bevel cut	0.67 of table value	0.41 of table value
$2" < W < 6"$	Square cut	0.46 of table value	0.41 of table value
$W > 6"$	Bevel cut	0.75 of table value	0.41 of table value

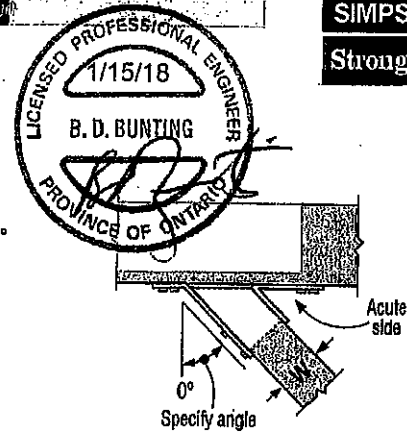

**Top View HHUS Hanger
Skewed Right**
(joist must be bevel cut)
All joist nails installed on the
outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ³	Header	Joist	D.F.R.L.		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
								lb.	lb.	lb.	lb.
Single 2x Sizes											
LUS24	18	1 1/8	3 1/2	1 1/4	2 1/4	(4) 10d	(2) 10d	710	1625	645	1155
								3.18	7.23	2.87	5.14
LU24L	22	1 1/8	3	1 1/4	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360	1020	320	725
								1.60	4.54	1.42	3.22
LU26L	22	1 1/8	5	1 1/4	4 1/4	(6) 10d	(4) 10d x 1 1/2"	720	1605	645	1140
								3.20	7.14	2.87	5.07
LUS26	18	1 1/8	4 1/4	1 1/4	3 1/4	(4) 10d	(4) 10d	1420	2170	1290	1630
								6.32	9.65	5.74	7.25
HUS26	18	1 1/8	5 1/4	3	3 1/8	(14) 16d	(6) 16d	2705	4940	2065	3875
								11.30	21.97	9.20	17.24
LJS26DS	18	1 1/8	5	3 1/2	4 1/4	(16) 16d	(6) 16d	2055	4265	1460	4115
								9.14	18.97	6.49	18.31
HGUS26	12	1 1/8	5 1/4	5	4 1/4	(20) 16d	(8) 16d	2685	6625	2685	5700
								11.96	28.51	11.98	25.35
LU28L	20	1 1/8	6 1/4	1 1/4	5 1/4	(8) 10d	(6) 10d x 1 1/2"	1140	2185	1020	1550
								5.07	9.72	4.54	6.89
LUS28	18	1 1/8	6 1/4	1 1/4	3 3/4	(6) 10d	(4) 10d	1420	2520	1290	1790
								6.32	11.21	5.74	7.96
HUS28	16	1 1/8	7 1/4	3	6 1/8	(22) 16d	(8) 16d	3605	5365	2675	4345
								16.04	23.86	11.90	19.33
HGUS28	12	1 1/8	7 1/4	5	6 1/4	(36) 16d	(12) 16d	3310	7675	3310	6900
								14.74	34.19	14.74	30.73
LU210L	20	1 1/8	8	1 1/4	7 1/4	(10) 10d	(6) 10d x 1 1/2"	1140	2495	1020	1770
								5.07	11.10	4.54	7.87
LUS210	18	1 1/8	7 1/4	1 1/4	3 3/4	(8) 10d	(4) 10d	1420	2785	1290	2210
								6.32	12.39	5.74	9.83

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27-28 for other nail sizes and information.

Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance							
		W	H	B	d _a ³	Header	Joist	D-Fir-L		S-P-F					
								Uplift	Normal	Uplift	Normal				
								(K _p = 1.15) lb.	(K _p = 1.00) lb.	(K _p = 1.15) lb.	(K _p = 1.00) lb.				
kN												kN	kN	kN	kN
Double 2x Sizes															
LUS24-2	18	3 1/8	3 1/8	2	1 1/4	(4) 16d	(2) 16d	835	2020	590	1435				
SS LUS26-2	18	3 1/8	4 1/8	2	4	(4) 16d	(4) 16d	3.71	8.99	2.62	6.38				
								1720	2595	1545	1920				
								7.65	11.54	6.87	8.64				
HHUS26-2	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	2850	7335	2065	5205				
HGUS28-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	12.68	32.63	9.20	23.15				
								4385	8950	3110	6355				
								19.51	39.81	13.83	28.27				
SS LUS28-2	18	3 1/8	7	2	4	(6) 16d	(4) 16d	1720	3325	1545	2575				
								7.65	14.79	6.87	11.45				
								3765	8940	2675	6345				
HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	16.76	39.77	11.90	28.22				
HGUS28-2	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215				
								27.00	57.74	19.17	40.99				
								2580	4500	2320	3195				
SS LUS210-2	18	3 1/8	9	2	6	(8) 16d	(8) 16d	11.48	20.02	10.32	14.21				
								4670	9660	4235	7000				
								20.77	42.97	18.84	31.14				
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d	6840	14015	4855	10270				
HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	30.43	62.34	21.80	45.68				
								4385	8950	3110	6355				
								19.51	39.81	13.83	28.27				
HGUS26-3	12	4 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	6070	12980	4310	9215				
								27.00	57.74	19.17	40.99				
								4670	9660	4235	6865				
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	20.77	43.02	18.84	30.54				
								6840	14645	4855	10400				
								30.43	65.14	21.60	46.26				
HGUS210-3	12	4 1/8	9 1/8	4	8 3/8	(46) 16d	(16) 16d	4385	8950	3110	6355				
								19.51	39.81	13.83	28.27				
								6070	12980	4310	9215				
HHUS210-4	14	6 1/8	8 1/8	3	7 1/8	(30) 16d	(10) 16d	20.77	43.02	18.84	30.54				
								6840	14645	4855	10400				
								30.43	65.14	21.60	46.26				
HGUS212-4	12	6 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10645				
								33.98	66.70	24.13	47.35				
								10130	16400	7195	11645				
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	45.06	72.95	32.00	51.80				
								4385	8950	3110	6355				
								19.51	39.81	13.83	28.27				
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215				
								27.00	57.74	19.17	40.99				
								4670	9660	4235	7210				
HHUS210-4	14	6 1/8	8 1/8	3	7 1/8	(30) 16d	(10) 16d	20.77	43.02	18.84	30.54				
								6840	14645	4855	10400				
								30.43	65.14	21.60	46.26				
HGUS212-4	12	6 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10645				
								33.98	66.70	24.13	47.35				
								10130	16400	7195	11645				
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	45.06	72.95	32.00	51.80				
								4385	8950	3110	6355				
								19.51	39.81	13.83	28.27				
LUS46	18	3 1/8	4 1/8	2	3 3/8	(4) 16d	(4) 16d	1720	2595	1545	1920				
								7.65	11.54	6.87	8.64				
								2840	7335	2065	5205				
HHUS46	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	11.30	32.63	9.20	23.15				
								4385	8950	3110	6355				
								19.51	39.81	13.83	28.27				
HGUS46	12	3 1/8	5 1/8	4	4 3/8	(20) 16d	(8) 16d	1720	3325	1545	2575				
								7.65	14.79	6.87	11.45				
								3765	8940	2675	6345				
LUS48	18	3 1/8	6 1/8	2	3 3/8	(6) 16d	(4) 16d	16.76	39.77	11.90	28.22				
								6070	12980	4310	9215				
								27.00	57.74	19.17	40.99				
HHUS48	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	2580	4500	2320	3195				
								11.48	20.02	10.32	14.21				
								4670	9660	4235	7000				
HGUS48	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	20.77	42.97	18.84	31.14				
								6840	14015	4855	10270				
								30.43	62.34	21.80	45.69				
LUS410	18	3 1/8	8 1/8	2	5 3/8	(8) 16d	(6) 16d	6840	14015	4855	10270				
								30.43	62.34	21.80	45.69				
								7640	14995	5425	10645				
HGUS410	12	3 1/8	9	4	8 1/8	(46) 16d	(16) 16d	33.98	66.70	24.13	47.35				
								10130	16400	7195	11645				
								45.06	72.95	32.00	51.80				
HGUS412	12	3 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	4385	8950	3110	6355				
								19.51	39.81	13.83	28.27				
								6070	12980	4310	9215				
HGUS414	12	3 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	20.77	42.97	18.84	31.14				
								6840	14015	4855	10270				
								30.43	62.34	21.80	45.69				

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to $1\frac{1}{4}$ ". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x $1\frac{1}{2}$ " = 0.148" dia. x $1\frac{1}{2}$ " long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

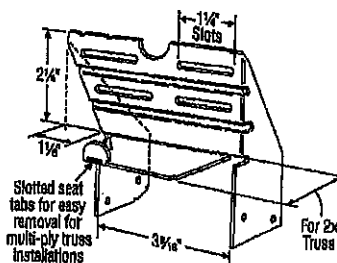


TC24
U.S. Patent 4,882,178

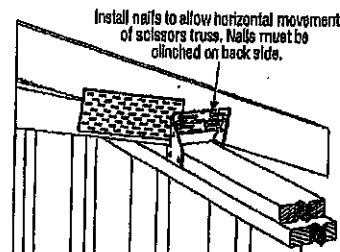


Typical TC24 Installation

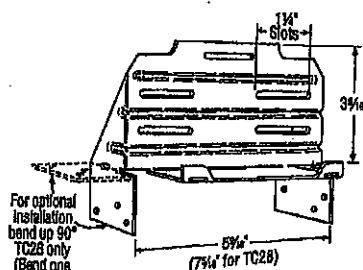

TC26
(TC28 Similar)

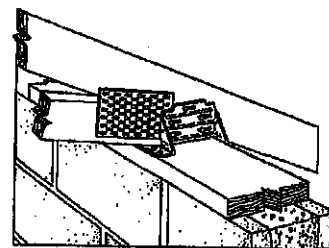

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer (8", 10", 12" Wall Installation Similar)

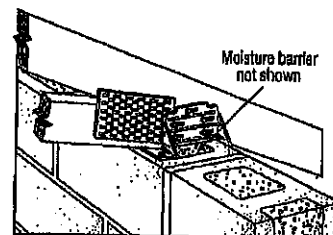

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _o =1.15)	Uplift (K _o =1.15)
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _o =1.15)	Uplift (K _o =1.15)
TC26	(5) 10d	(6) 10d x $1\frac{1}{2}$ "	810	660
	(5) 10d	(6) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.
4. TC26 fastened to grouted concrete block with (5) - $\frac{1}{4}$ " x 2 $\frac{1}{4}$ " Titen screws has a factored uplift resistance of 275 lb.



(800) 999-5099
strongtie.com

H/TSP

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_p = 1.15$)					
					D.Fir-L			S-P-F		
		To Rafters/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
					F ₁	F ₁	F ₂	F ₁	F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(6) 8d x 1½"	(4) 8d	—	740	685	300	680	485	215
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
SS H2.5A	18	(5) 8d	(5) 8d	—	805	160	160	765	160	160
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
SS H3	18	(4) 8d	(4) 8d	—	740	180	285	615	125	190
H6	18	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
H7Z	18	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
SS H8 ³	18	(5) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
SS H10A ³	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	585	290
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
H10S ^{2A}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1465	795	315	1040	585	225
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
H14	18	[1] (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
		[2] (12) 8d x 1½"	(15) 8d	—	2390	855	320	1805	610	230
TSP	18	(9) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
		(9) 10d x 1½"	(6) 10d	—	1580	440	—	1105	310	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 695 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.162" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4.
10. This design is not valid after March 31, 2021.

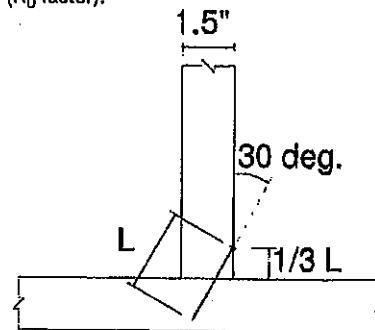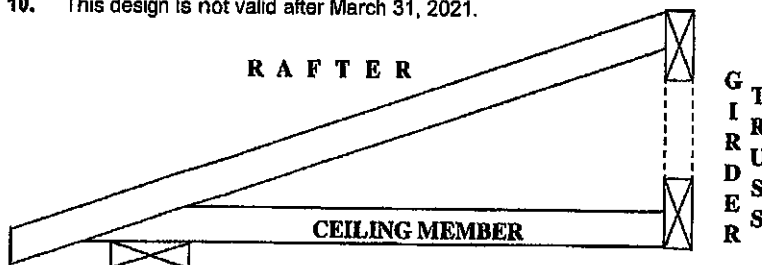


TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37679H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

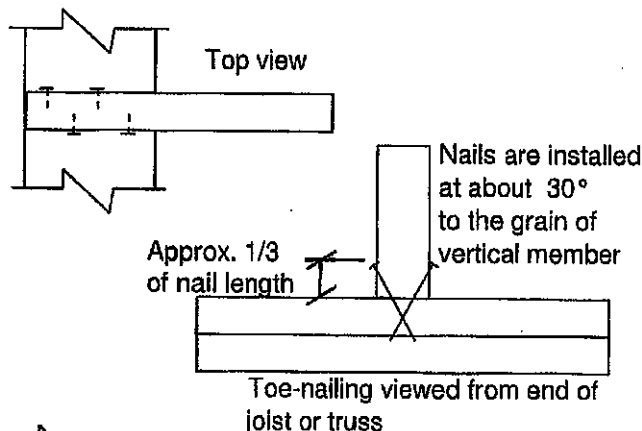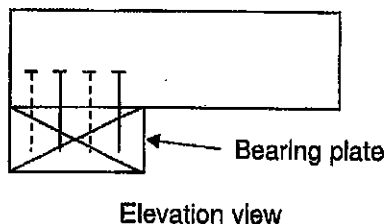

Toe-nailing on 2x4 Bearing Plate

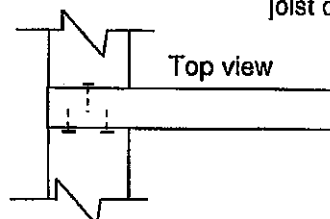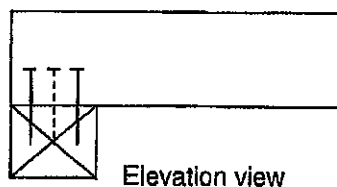

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7


PEO
Certificate No. 10889485




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint, unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/8" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

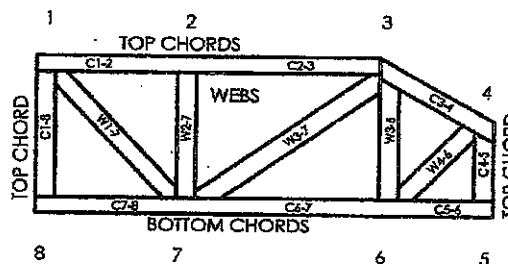

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MH-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stock materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

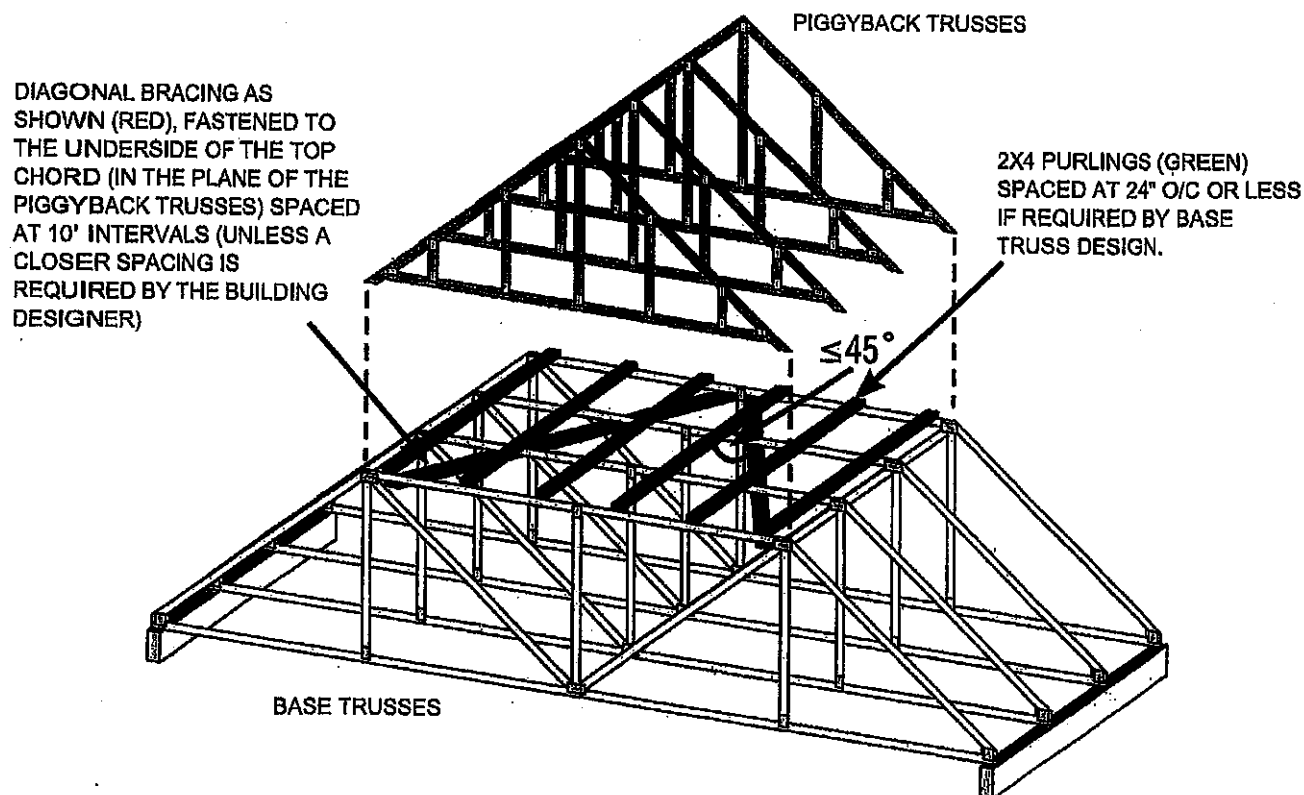

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1900213

Feb 09, 2018