


WINDOWS - CANADA ZONE B


- (1) MINIMUM BEDROOM WINDOW (OBC 9.9.10.1.)
AT LEAST ONE BEDROOM WINDOW ON A GIVEN FLOOR IS TO HAVE MIN. 0.89m² (9.6 SQFT.) UNOBSTRUCTED GLAZED OPENABLE AREA WITH MIN. CLEAR WIDTH OF 800mm (31-1/2")
GLASS AREA NOT MORE THAN 1% OF GROSS PERIPHERAL WALL AREA.
MAXIMUM U-VALUE 0.22
- (2) WINDOW GUARDS (OBC 9.8.8.1(6))
A GUARD IS REQUIRED WHERE THE TOP OF THE WINDOW SILL IS LOCATED LESS THAN 400mm (1'-6") ABOVE FIN. FLOOR AND THE DISTANCE FROM THE FIN. FLOOR TO THE ADJACENT GRADE IS GREATER THAN 1800mm (5'-11")

GENERAL:


- (1) MECHANICAL VENTILATION
MECHANICAL VENTILATION IS REQUIRED TO PROVIDE 0.3 AIR CHANGES PER HOUR AVERAGED OVER 24 HOURS. SEE MECHANICAL DRAWINGS.
 - (2) OUTDOOR AIR INTAKE
ALL OUTDOOR AIR INTAKES SHALL BE LOCATED SO THAT THEY ARE SEPARATED FROM SOURCES OF CONTAMINATION (EXHAUST VENTS) IN COMPLIANCE WITH O.B.C. DIV-B 6.2.3.12. AND TABLE 6.2.3.12.
 - (3) REINFORCEMENT FOR GRAB BARS (OBC 9.5.2.3.)
REINFORCEMENT OF STUD WALLS SHALL BE INSTALLED ADJACENT TO WATER CLOSETS AND SHOWER OR BATHUB IN MAIN BATHROOM. REFER TO O.B.C. 4.5.2.3, 3.2.3.3(1)(a), 3.2.3.3(3)(c), 5.2.3.3(2)(g) & 5.2.3.3(4)(a). SEE DETAIL ON PAGE II.
- L

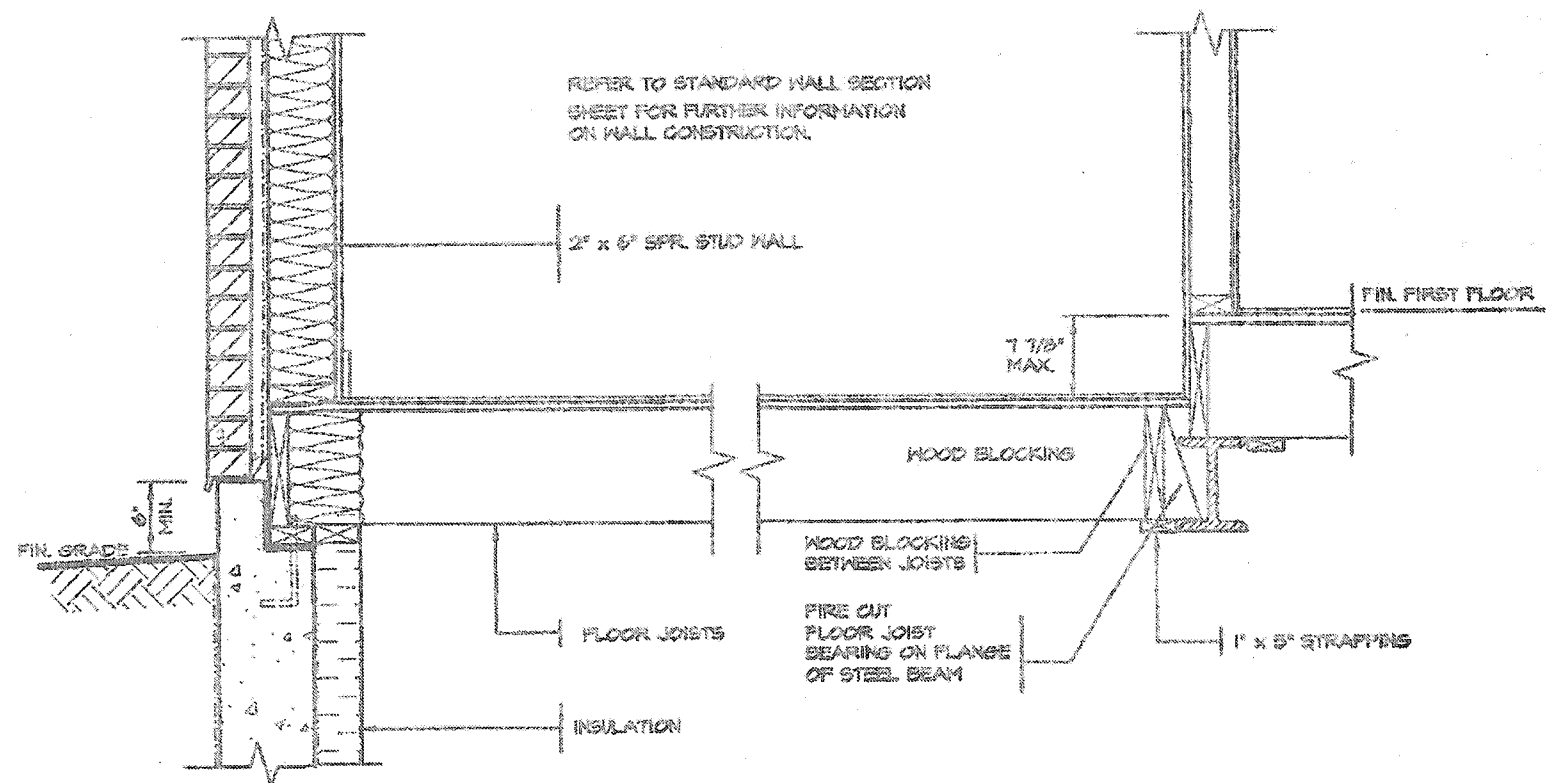

DETAIL OF SUNKEN LAUNDRY
(ONE RISER)

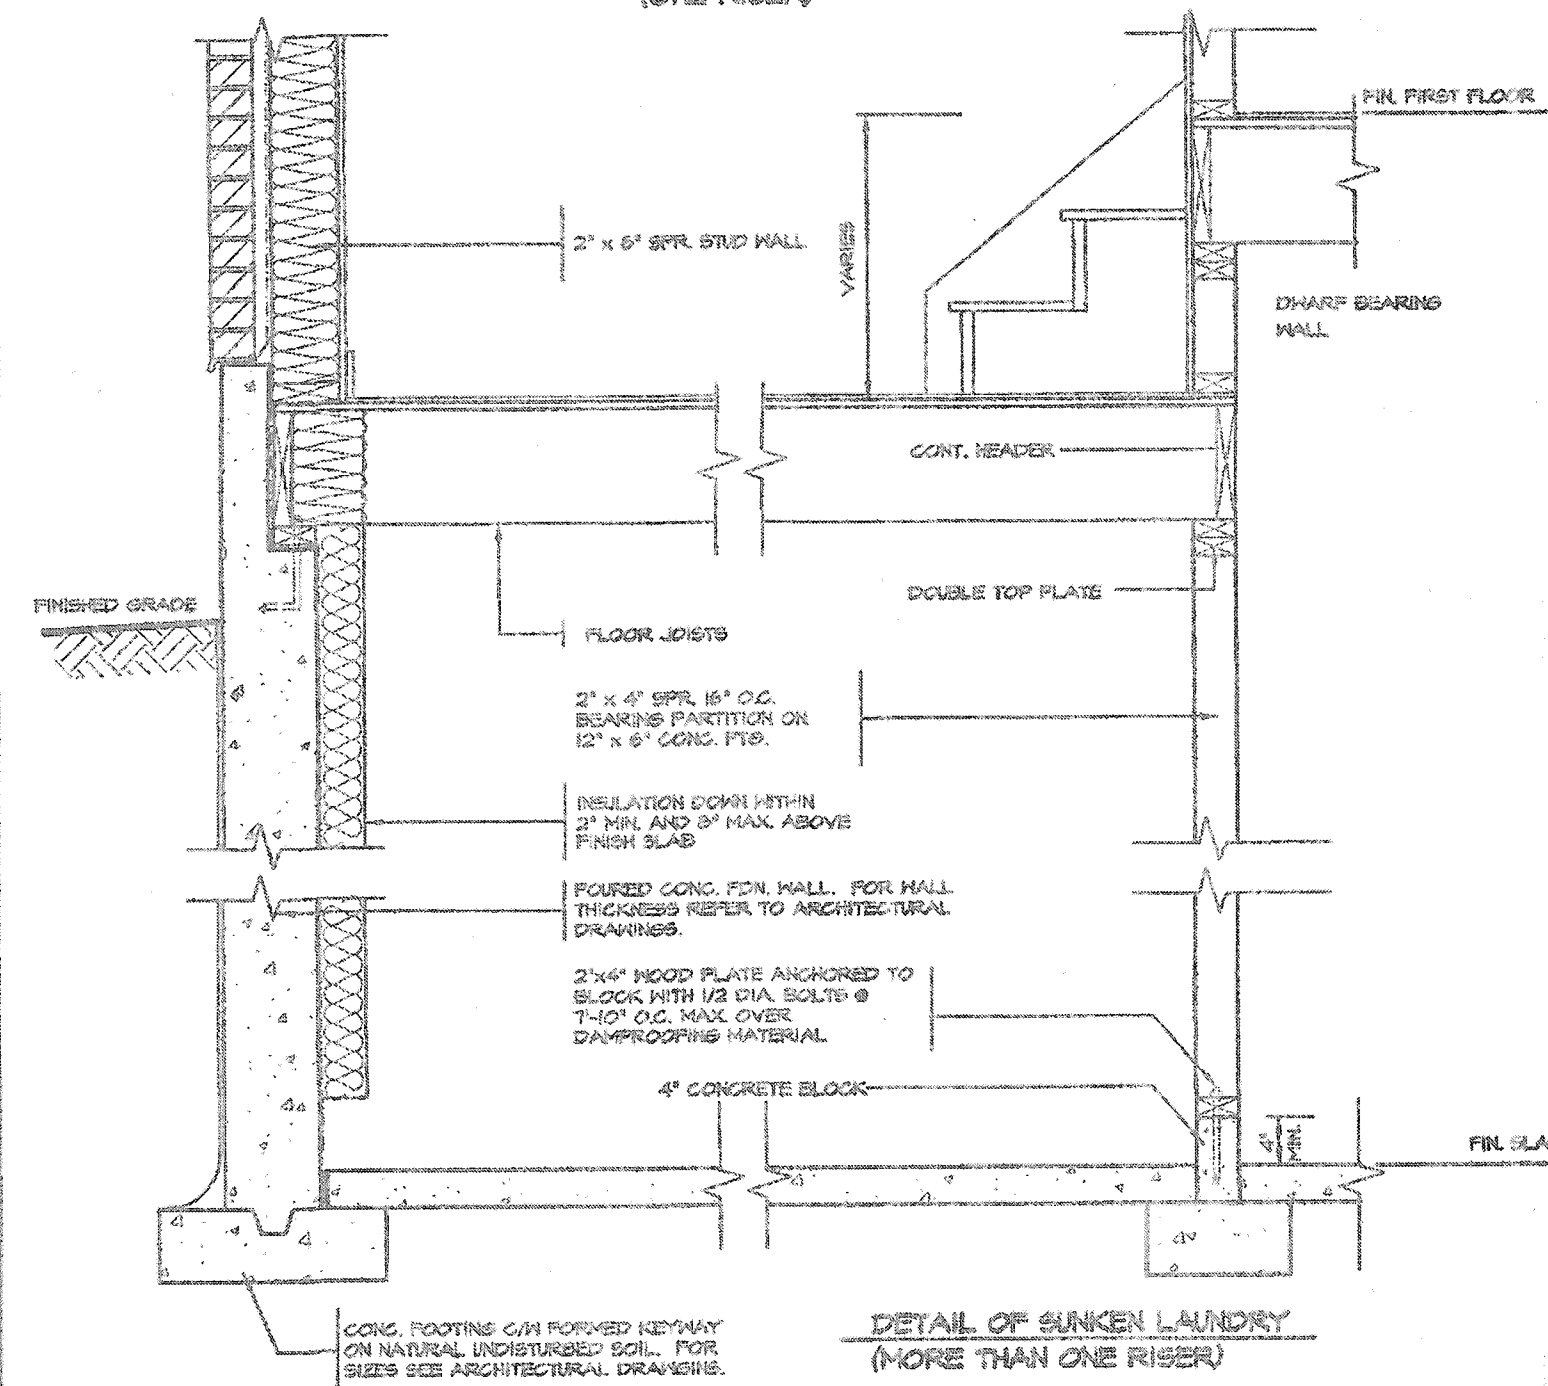

DETAIL OF SUNKEN LAUNDRY
(MORE THAN ONE RISER)

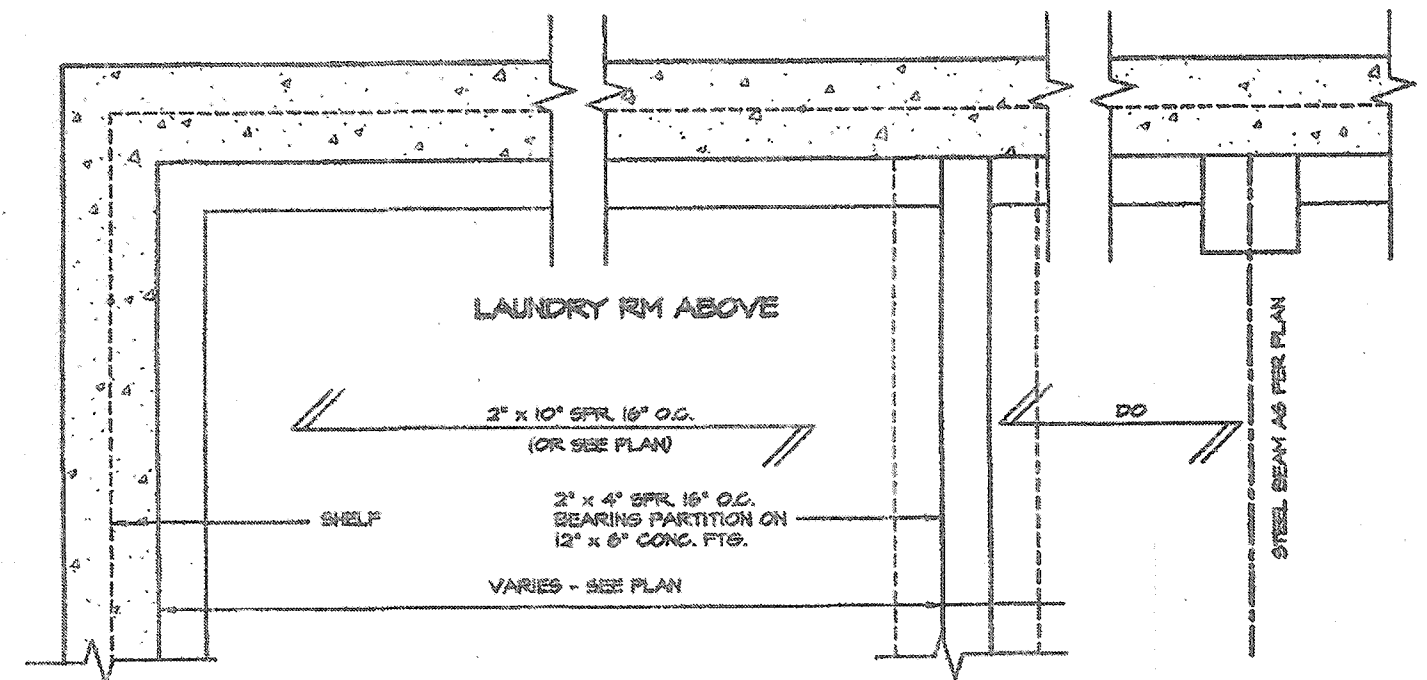

PARTIAL PLAN



2012 CODE
COMPLIANCE PACKAGE "A1"

1. ISSUED FOR PERMIT JUL 30, 2018 REVISIONS
