


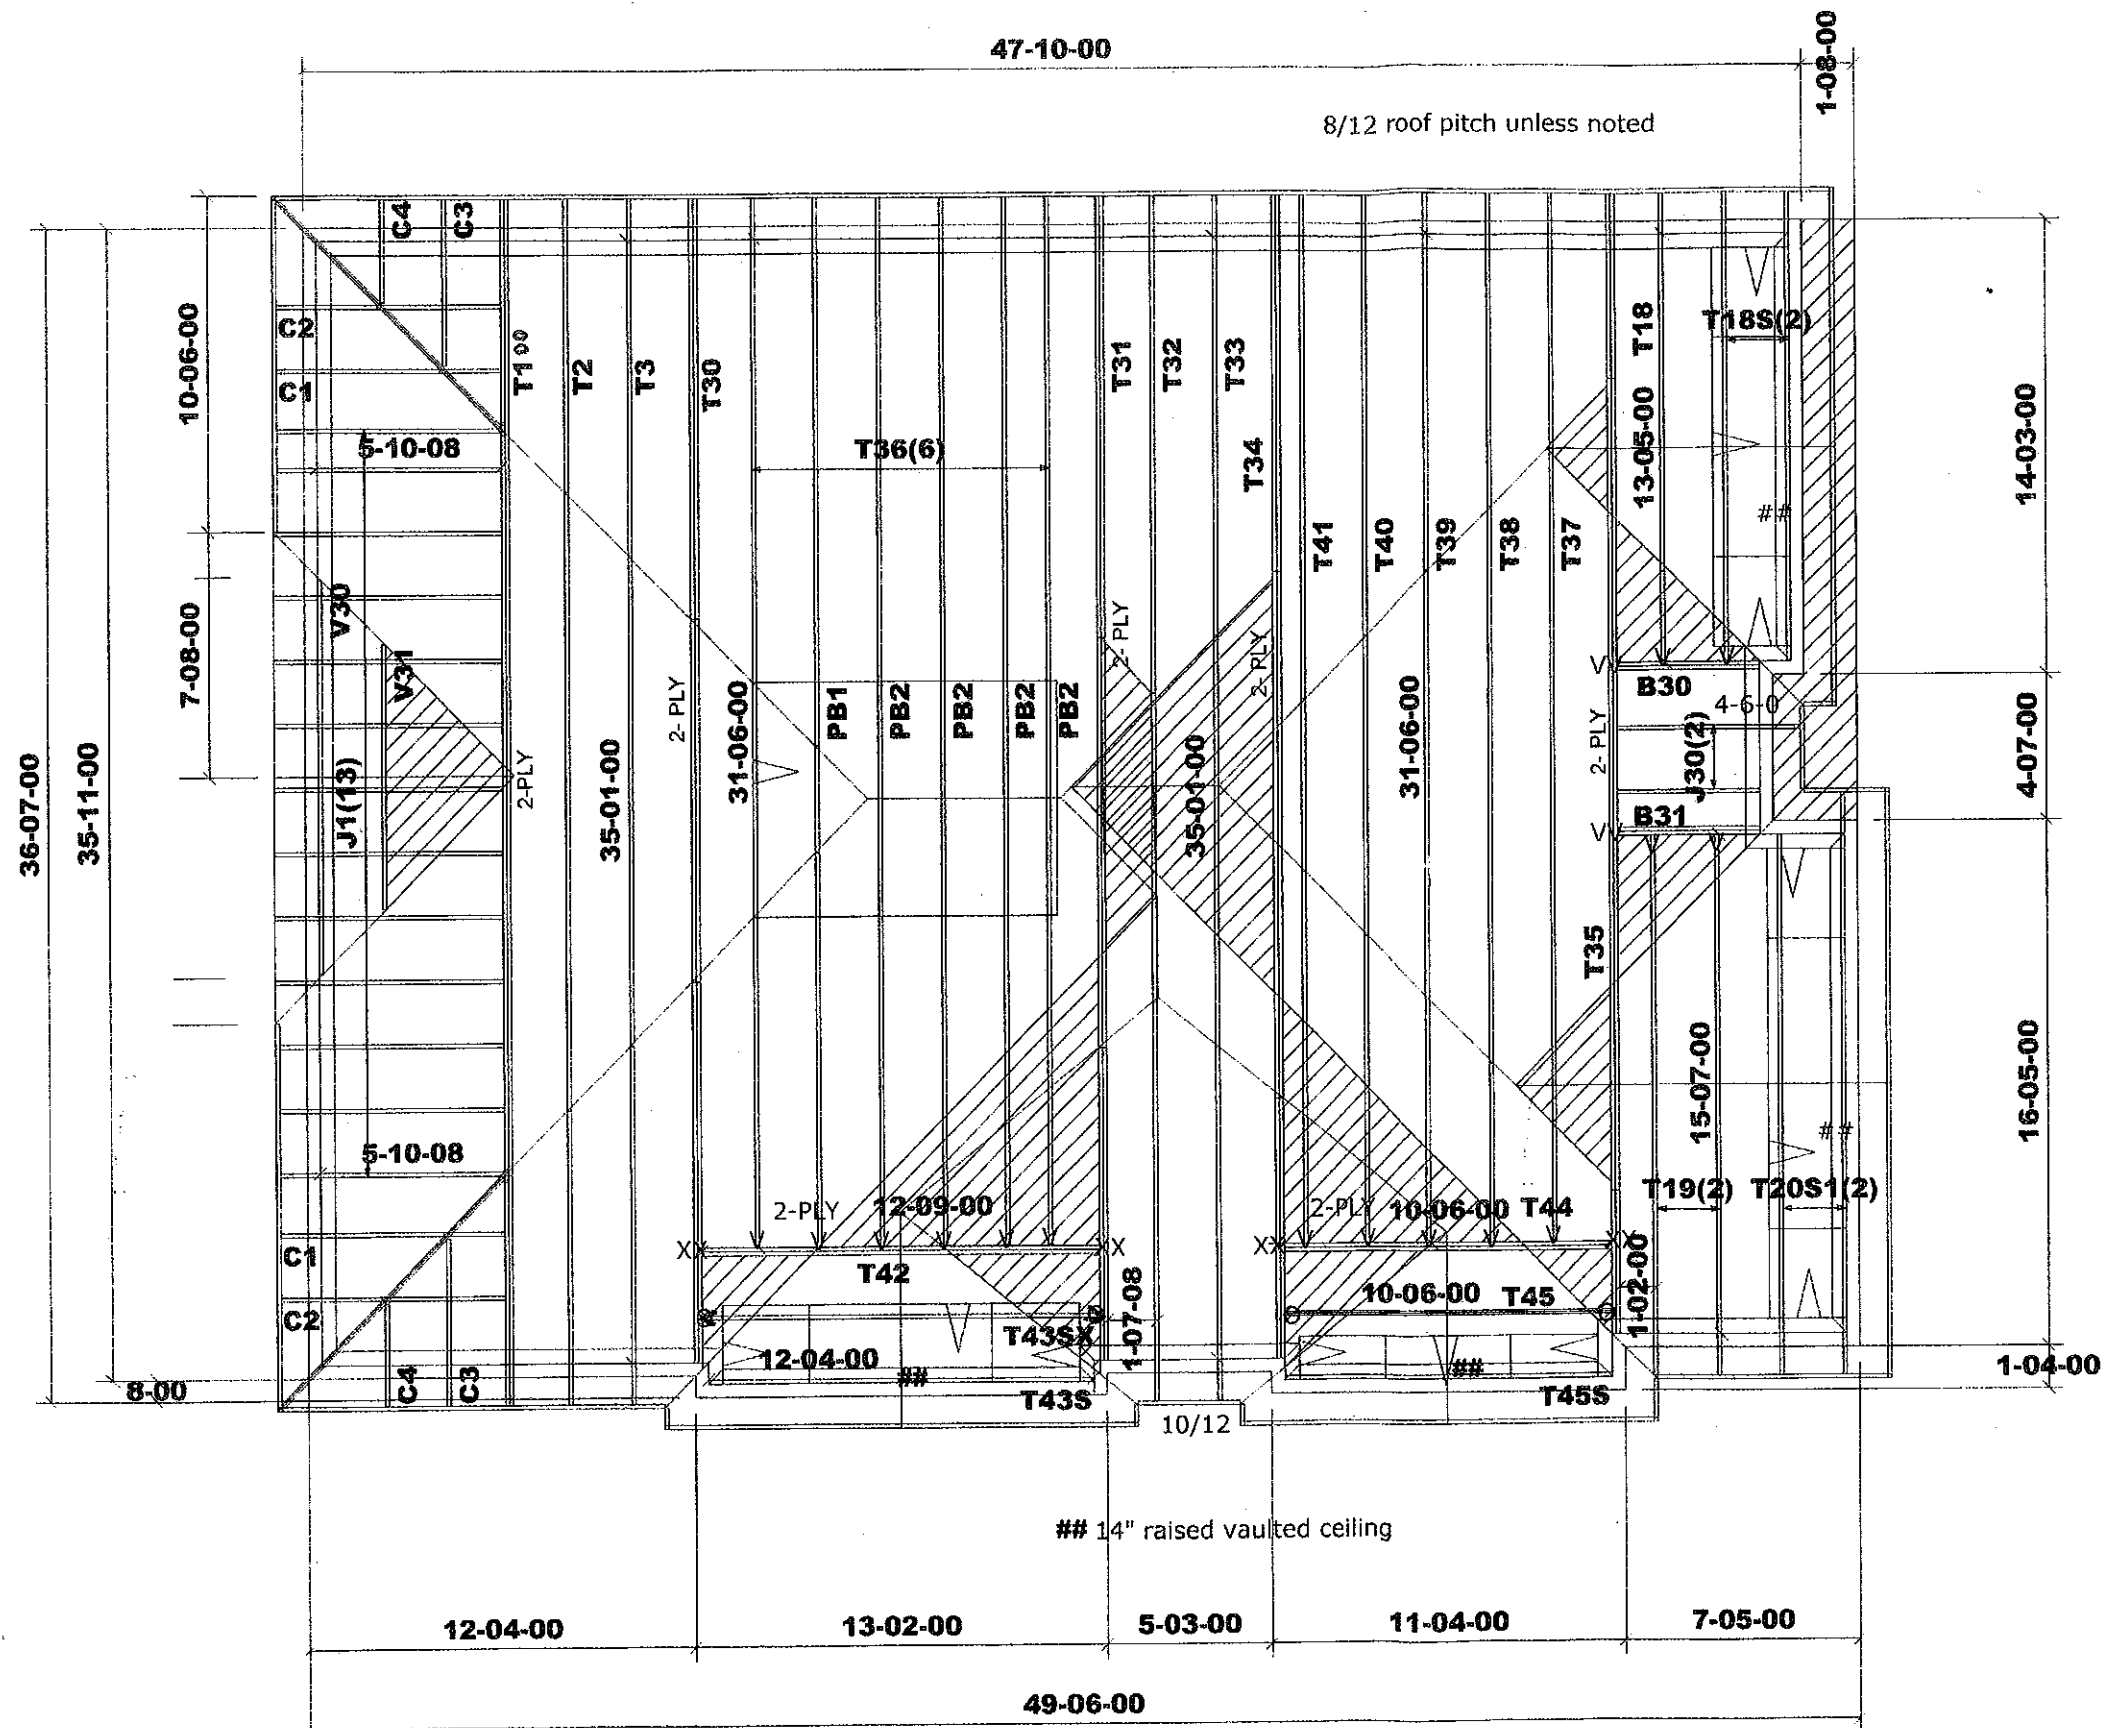

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.


All conventional framing to conform with Part 9 of O.B.C. 2012 (2019 amendment). Roof rafters that cross over or meet trusses to be min. 2x4 SPF #2 @ 24" o/c with a vertical post to the truss at each cross point. Vertical posts longer than 6' to have lateral bracing so that the distance between the post end points and lateral bracing does not exceed 6'.


DESIGN CONFORMS WITH OBC 2012
(2019 amendment) OCCUPANCY:
RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
HGUS26-2 - (XX)
LJS26DS - (V)
LUS24 - (O)
LUS26-2-(VV)

BEAMS:
B30= B31 =
2 - 2x10 SPF #2

 DENOTES:
CONVENTIONAL
FRAMING

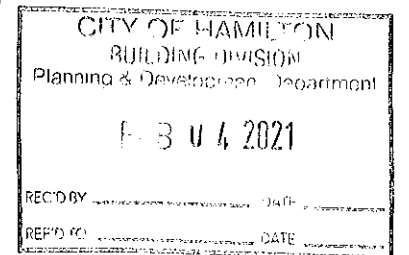

MI 3140



Job Track: **51225**
Plan Log: **202439**
Layout ID: **408316**

Builder / Location:
GREEN PARK HOMES / WATERDOWN
Project: **RUSSELL GARDENS PH.3**
Date: 2020-04-29 Sales: Mario DiCano Designer: JG

Model / Elevation:
MOUNTAINASH 12/2

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE

LOT 225

Scale ver 8.3.1.215

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 12
 Lot #: 225
 Elevation: 2

Job Track: 51225
 PlanLog: 202439
 Layout ID: 408316
 Ref #
 Page: 1 of 3
 Date: 04-29-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T100 Hip Girder	8 / 12	35-01-00	5-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	327.59 201.00		
	1	T2 Hip	8 / 12	35-01-00	6-07-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	150.61 96.17		
	1	T3 Hip	8 / 12	35-01-00	7-11-13	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	157.43 98.33		
	1	T18 Common	8 / 12	13-05-00	5-10-08	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	58.32 37.00		
	2	T18S Roof Special	8 / 12 5 / 12	13-05-00	5-10-08	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	114.8 74.00		
	2	T19 Common	8 / 12	15-07-00	6-07-02	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	132.91 84.00		
	2	T20S1 Roof Special	8 / 12 5 / 12	15-07-00	6-07-02	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	131.62 88.33		
	1 2-ply	T30 Hip Girder	8 / 12	35-01-00	9-03-15	2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	437.22 265.00		
	1 2-ply	T31 Roof Special Girder	8 / 12	35-01-00	9-09-02	2 x 4 2 x 6	1-03-08	1-04-13 1-07-10	377.44 230.67		
	1	T32 Roof Special	8 / 12	35-01-00	10-11-02	2 x 4	1-03-08 1-03-08	1-04-13 1-07-10	187.9 115.67		
	1	T33 Roof Special	8 / 12	35-01-00	9-08-13	2 x 4	1-03-08 1-03-08	1-04-13 1-07-10	169.56 106.50		
	1 2-ply	T34 Roof Special Girder	8 / 12	35-01-00	8-04-13	2 x 4 2 x 6	1-03-08	1-04-13 1-07-10	369.66 228.33		
	1 2-ply	T35 Hip Girder	8 / 12	34-05-00	4-04-13	2 x 4 2 x 6	1-03-08 1-03-08	1-04-13 1-04-13	348.56 217.33		
	6	T36 Hip	8 / 12	31-06-00	10-07-13	2 x 4	1-03-08	1-04-13 3-09-08	984.11 610.00		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 12
 Lot #: 225
 Elevation: 2

Job Track: 51225
 PlanLog: 202439
 Layout ID: 408316
 Ref #
 Page: 2 of 3
 Date: 04-29-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T37 Hip	8 / 12	31-06-00	5-08-13	2 x 4	1-03-08	1-04-13 3-04-02	129.05 81.67		
	1	T38 Hip	8 / 12	31-06-00	7-00-13	2 x 4	1-03-08	1-04-13 3-04-02	139.38 87.17		
	1	T39 Hip	8 / 12	31-06-00	8-04-13	2 x 4	1-03-08	1-04-13 3-04-02	148.29 92.67		
	1	T40 Hip	8 / 12	31-06-00	9-08-13	2 x 4	1-03-08	1-04-13 3-04-02	158.47 99.67		
	1	T41 Hip	8 / 12	31-06-00	11-00-13	2 x 4	1-03-08	1-04-13 3-04-02	155.42 96.50		
	1 2-ply	T42 Common Girder	8 / 12	12-09-00	5-06-02	2 x 4 2 x 6		1-03-02 1-03-02	128.29 78.67		
	1	T43S Roof Special	8 / 12 5 / 12	12-04-00	5-06-02	2 x 4		1-04-13 1-04-13	50.13 32.67		
	1	T43SX Roof Special	8 / 12 5 / 12	12-09-00	5-06-02	2 x 4		1-03-02 1-03-02	51.43 33.67		
	1 2-ply	T44 Common Girder	8 / 12	10-06-00	4-10-13	2 x 4		1-04-13 1-04-13	93.02 60.00		
	1	T45 Common	8 / 12	10-06-00	4-10-13	2 x 4		1-04-13 1-04-13	40.51 25.50		
	1	T45S Roof Special	8 / 12 5 / 12	10-06-00	4-10-13	2 x 4		1-04-13 1-04-13	43.88 29.00		
	1	PB1 Piggyback	8 / 12	7-04-00	1-04-00	2 x 4			19.39 13.17		
	4	PB2 Piggyback	8 / 12	7-04-00	2-05-05	2 x 4			72.32 46.67		
	1	V30 Valley	8 / 12	12-03-00	4-01-00	2 x 4			35.76 23.00		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 12
 Lot #: 225
 Elevation: 2

Job Track: 51225
 PlanLog: 202439
 Layout ID: 408316
 Ref #
 Page: 3 of 3
 Date: 04-29-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	V31 Valley	8 / 12	8-03-00	2-09-00	2 x 4			21.09 14.17		
	13	J1 Jack-Open	8 / 12	5-10-08	5-03-13	2 x 4	1-05-00	1-04-13 5-03-13	251.71 151.67		
	2	J30 Jack-Open	8 / 12	4-06-00	4-04-13	2 x 4	1-03-08	1-04-13 4-04-13	31.48 20.67		
	2	C1 Jack-Open	8 / 12	3-10-15	4-00-02	2 x 4	1-03-08 1-11-09	1-04-13 4-00-02	33 20.67		
	2	C2 Jack-Open	8 / 12	1-10-15	2-08-02	2 x 4	1-03-08 3-11-09	1-04-13 2-08-02	27.45 18.00		
	2	C3 Jack-Open	8 / 12	2-00-00	4-00-02	2 x 4	1-03-08 1-10-15	1-04-13 2-08-13	24.83 15.33		
	2	C4 Jack-Open	8 / 12	1-10-15	2-08-02	2 x 4	1-03-08 1-01	1-04-13 2-08-02	19.15 12.67		

TOTAL # TRUSS= 70

TOTAL BFT OF ALL TRUSSES= 3503.54 BFT.

TOTAL WEIGHT OF ALL TRSSES 5821.57 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
4	Hardware	HGUS26-2	
15	Hardware	LJS26DS	
4	Hardware	LUS24	
2	Hardware	LUS26-2	


TOTAL NUMBER OF
ITEMS=

25

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	T1	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:31 2020 Page 1
ID:DMCubINVR6TslFoa31v6l_zns1l-1gwC7aEIXum?YIAqletJlBTresjnyC01QXp2d_zLafA

1-3-8 00 5-10-8 5-10-8 5-10-10 11-9-2 2-2-8 13-11-8 3-7-0 17-6-8 3-7-0 21-1-8 2-2-8 23-3-14 5-10-10 29-2-8 35-1-0 1-3-8
Scale = 1:57.5

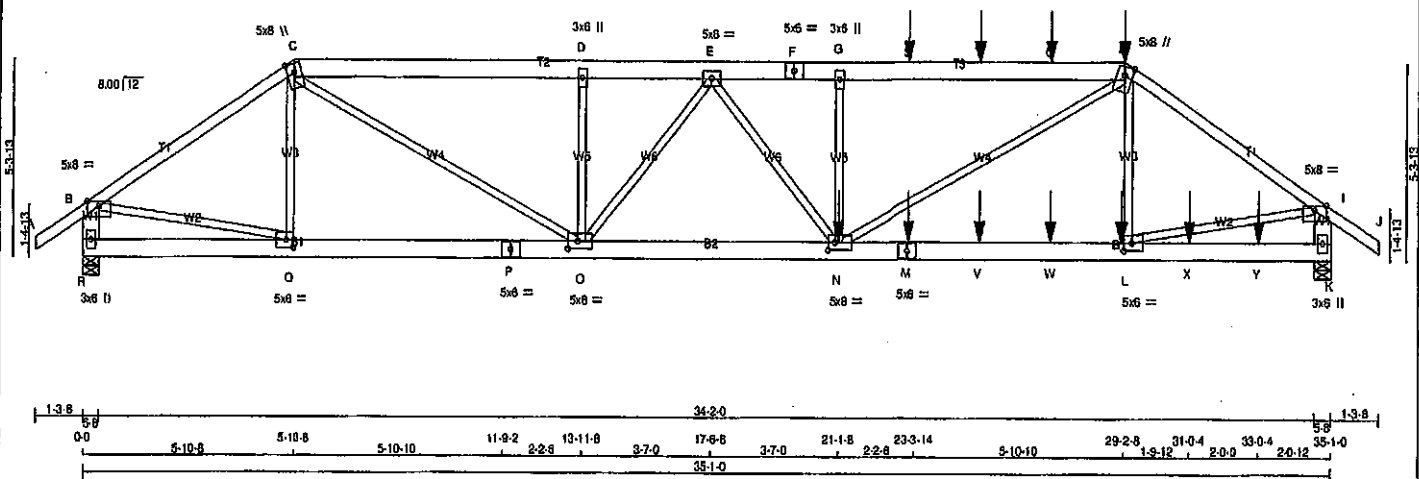

TOTAL WEIGHT = 2 X 175 = 350 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - F	2x6	DRY	No.2
F - H	2x6	DRY	No.2
H - J	2x4	DRY	No.2
R - B	2x6	DRY	No.2
K - I	2x6	DRY	No.2
R - P	2x6	DRY	No.2
P - M	2x6	DRY	No.2
M - K	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C 1	12	TOP
H-J 1	12	SIDE(81.0)
C-F 2	12	TOP
F-H 2	12	SIDE(81.0)
R-B 2	12	TOP
K-I 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
R-P 2	12	TOP
P-M 2	12	SIDE(183.1)
M-K 2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
L-H 1	6	SIDE(18.3)
N-G 1	6	SIDE(240.7)
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
R	2990	0	0	5-8	5-8
K	4041	0	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	2109	1413 / 0	0 / 0	0 / 0	0 / 0	696 / 0	0 / 0	0 / 0
K	2853	1899 / 0	0 / 0	0 / 0	0 / 0	953 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.84 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (L)
FR-TO	FROM	FR-TO	FROM
A-B	0 / 35	-91.8	-91.8 0.07 (1)
B-C	-3876 / 0	-91.8	-91.8 0.45 (1)
C-D	-8111 / 0	-91.8	-91.8 0.30 (1)
D-E	-8111 / 0	-91.8	-91.8 0.23 (1)
E-F	-7582 / 0	-91.8	-91.8 0.41 (1)
F-G	-7582 / 0	-91.8	-91.8 0.41 (1)
G-H	-7583 / 0	-91.8	-91.8 0.58 (1)
H-I	-7583 / 0	-91.8	-91.8 0.58 (1)
I-J	-5157 / 0	-91.8	-91.8 0.58 (1)
J-K	0 / 35	-91.8	-91.8 0.07 (1)
R-B	-2954 / 0	0.0	0.0 0.11 (1)
K-I	-3985 / 0	0.0	0.0 0.14 (1)
R-Q	0 / 0	-18.5	-18.5 0.06 (4)
Q-P	0 / 3073	-18.5	-18.5 0.24 (1)
P-O	0 / 3073	-18.5	-18.5 0.24 (1)
O-N	0 / 8782	-18.5	-18.5 0.48 (1)
N-M	0 / 4309	-18.5	-18.5 0.38 (1)
M-V	0 / 4309	-18.5	-18.5 0.38 (1)
V-W	0 / 4309	-18.5	-18.5 0.38 (1)
W-L	0 / 4309	-18.5	-18.5 0.38 (1)
L-X	0 / 0	-18.5	-18.5 0.12 (4)
X-Y	0 / 0	-18.5	-18.5 0.12 (4)
Y-K	0 / 0	-18.5	-18.5 0.12 (4)

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LOC1	MAX.	MAX+	FACE	OIR.	TYPE	HEEL	CONN.
H	29-2-8	-538	-538	---	FRONT	VERT	TOTAL	---	C1
L	29-1-12	-38	-38	---	FRONT	VERT	TOTAL	---	C1
M	29-1-12	-38	-38	---	FRONT	VERT	TOTAL	---	C1
N	21-1-8	-1824	-1824	---	FRONT	VERT	TOTAL	---	C1
S	23-1-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
T	25-1-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
U	27-1-12	-178	-178	---	FRONT	VERT	TOTAL	---	C1
V	25-1-12	-38	-38	---	FRONT	VERT	TOTAL	---	C1
W	27-1-12	-38	-38	---	FRONT	VERT	TOTAL	---	C1
X	31-0-4	-38	-38	---	FRONT	VERT	TOTAL	---	C1
Y	33-0-4	-38	-38	---	FRONT	VERT	TOTAL	---	C1

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/380 (1.17)
CALCULATED VERT. DEFL. (LL) = L/999 (0.17)
ALLOWABLE DEFL. (TL) = L/380 (1.17)
CALCULATED VERT. DEFL. (TL) = L/999 (0.30)

CSI: TC=0.58/1.00 (H-E), BC=0.48/1.00 (N-O-1),
WB=0.54/1.00 (I-L-1), SS=0.25/1.00 (G-H-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1655

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (L) (INPUT = 0.90)
JSI METAL = 0.54 (L) (INPUT = 1.00)



Structural component only
DWG# T-2008005 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	T1	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:32 2020 Page 2

ID:DMCubINVR8TsF0e31v6I zns1I-VsUaKwFKIBus9rICMOYrO00NF3whIGA9BZc9QzLaf

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW-p	MT20	5.0	8.0	Edge	
C	TTWW+m	MT20	5.0	8.0	Edge	
D	TMW-w	MT20	3.0	6.0		
E	TMWW-t	MT20	5.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMW-w	MT20	3.0	6.0		
H	TTWW+m	MT20	5.0	8.0	Edge	
I	TMW-p	MT20	5.0	8.0	Edge	
K	BMV1-p	MT20	3.0	6.0		
L	BMWW-t	MT20	5.0	6.0	2.50	2.50
M	BS-t	MT20	5.0	6.0		
N	BMWW-t	MT20	5.0	8.0	2.50	2.25
O	BMWW-t	MT20	5.0	8.0	2.50	3.25
P	BS-t	MT20	5.0	6.0		
Q	BMWW-t	MT20	5.0	6.0	2.50	2.60
R	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only,
DWG# T-2008005 2/2

JOB NAME 408316	TRUSS NAME T100	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Kamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:05:38 2020 Page 1

ID:DMCubINVR6TstFos31v6t_zns11-bUB31W0TqgZdH95325Lmslax0Me479K7VatzqzLa9B



LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
S - B	2x6	DRY	No.2	SPF	
K - I	2x8	DRY	No.2	SPF	
S - P	2x6	DRY	No.2	SPF	
P - N	2x6	DRY	No.2	SPF	
N - K	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A - G	12	SIDE(81.0)
C - F	12	SIDE(81.0)
F - H	12	SIDE(81.0)
H - J	12	SIDE(81.0)
S - B	12	TOP
K - I	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
S - P	12	SIDE(183.1)
P - N	12	SIDE(183.1)
N - K	12	SIDE(183.1)
WEBS: (0.122"x3") SPIRAL NAILS		
R - C	6	SIDE(19.3)
L - H	6	SIDE(19.3)
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
S	3909	0	3909	0
K	3859	0	3859	0

UNFACTORED REACTIONS

1ST CASE	MAX	MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
S	2783	1823 / 0	0 / 0
K	2727	1799 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.84 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MAX. FACTORED UNBRACED LENGTH (LBS)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)
FR-TO						FR-TO			
A-B	0:35	-91.8	-91.8	0.07 (1)	10.00	R-C	-431 / 54	0.09 (1)	
B-C	-4949 / 0	-91.8	-91.8	0.55 (1)	3.82	C-Q	0 / 3051	0.38 (1)	
C-T	-8443 / 0	-91.8	-91.8	0.54 (1)	3.05	D-O	-1748 / 0	0.35 (1)	
T-U	-8443 / 0	-91.8	-91.8	0.54 (1)	3.05	O-E	0 / 857	0.11 (1)	
U-V	-8443 / 0	-91.8	-91.8	0.54 (1)	3.05	E-G	-957 / 0	0.19 (1)	
V-D	-8443 / 0	-91.8	-91.8	0.54 (1)	3.05	G-Q	0 / 907	0.11 (1)	
D-W	-7094 / 0	-91.8	-91.8	0.59 (1)	2.84	M-G	-1769 / 0	0.38 (1)	
W-X	-7094 / 0	-91.8	-91.8	0.59 (1)	2.84	M-H	0 / 3081	0.38 (1)	
X-Y	-7094 / 0	-91.8	-91.8	0.59 (1)	2.84	L-H	-433 / 44	0.09 (1)	
Y-E	-7094 / 0	-91.8	-91.8	0.59 (1)	2.84	B-R	0 / 4170	0.52 (1)	
E-Z	-7094 / 0	-91.8	-91.8	0.54 (1)	2.93	L-I	0 / 4108	0.51 (1)	
Z-F	-7094 / 0	-91.8	-91.8	0.54 (1)	2.93				
F-AA	-7094 / 0	-91.8	-91.8	0.54 (1)	2.93				
AA-G	-7094 / 0	-91.8	-91.8	0.54 (1)	2.93				
G-AB	-6405 / 0	-91.8	-91.8	0.79 (1)	3.14				
AB-AC	-6405 / 0	-91.8	-91.8	0.79 (1)	3.14				
AC-H	-6405 / 0	-91.8	-91.8	0.79 (1)	3.14				
H-I	-4875 / 0	-91.8	-91.8	0.54 (1)	3.85				
I-J	0:35	-91.8	-91.8	0.07 (1)	10.00				
S-B	-3833 / 0	0.0	0.0	0.14 (1)	7.22				
K-I	-3782 / 0	0.0	0.0	0.14 (1)	7.22				
S-AD	0:0	-18.5	-18.5	0.07 (4)	10.00				
AD-AE	0:0	-18.5	-18.5	0.07 (4)	10.00				
AE-R	0:0	-18.5	-18.5	0.07 (4)	10.00				
R-AF	0:4104	-18.5	-18.5	0.31 (1)	10.00				
AF-AG	0:4104	-18.5	-18.5	0.31 (1)	10.00				
AG-AH	0:4104	-18.5	-18.5	0.31 (1)	10.00				
AH-Q	0:4104	-18.5	-18.5	0.31 (1)	10.00				
Q-AI	0:6443	-18.5	-18.5	0.48 (1)	10.00				
AI-P	0:6443	-18.5	-18.5	0.48 (1)	10.00				
P-AJ	0:6443	-18.5	-18.5	0.48 (1)	10.00				
AJ-AK	0:6443	-18.5	-18.5	0.48 (1)	10.00				
AK-O	0:6443	-18.5	-18.5	0.48 (1)	10.00				
O-AL	0:6405	-18.5	-18.5	0.48 (1)	10.00				
AL-N	0:6405	-18.5	-18.5	0.48 (1)	10.00				
N-M	0:6405	-18.5	-18.5	0.48 (1)	10.00				
M-AM	0:4043	-18.5	-18.5	0.30 (1)	10.00				
AM-AN	0:4043	-18.5	-18.5	0.30 (1)	10.00				
AN-L	0:4043	-18.5	-18.5	0.30 (1)	10.00				
L-AO	0:0	-18.5	-18.5	0.07 (4)	10.00				
AO-AP	0:0	-18.5	-18.5	0.07 (4)	10.00				
AP-K	0:0	-18.5	-18.5	0.07 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NSCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.19')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.35')

CSI: TC=0.59/1.00 (D-E:1), BC=0.48/1.00 (O-Q:1), WB=0.52/1.00 (B-R:1), SSI=0.28/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (R) (INPUT = 0.90)

JSI METAL = 0.61 (PI) (INPUT = 1.00)



Structural component only
DWG# T-2008047 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T100	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 10:05:38 2020 Page 2

ID:DMCubINVR6TslFoe31v6l zns1i-bU83iW0TogZdH95325Lmslax0Me479K7VAIzoZLa9B

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	5.0	8.0	Edge	
C	TTWW-m	MT20	8.0	9.0	Edge	
D	TMWW-i	MT20	4.0	4.0		
E	TMWW-w	MT20	2.0	4.0		
F	TS-i	MT20	3.0	8.0		
G	TMWW-i	MT20	4.0	4.0		
H	TTWW-m	MT20	8.0	9.0	Edge	
I	TMWW-p	MT20	5.0	8.0	Edge	
K	BMVI-p	MT20	3.0	6.0		
L	BMWW-i	MT20	5.0	6.0	2.50	2.75
M	BMWW-i	MT20	5.0	6.0		
N	BS-i	MT20	5.0	8.0		
O	BMWWW-i	MT20	5.0	8.0		
P	BS-i	MT20	5.0	8.0		
Q	BMWW-i	MT20	5.0	6.0		
R	BMWW-i	MT20	5.0	6.0	2.50	2.75
S	BMVI-p	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	.542	.542	---	FRONT	VERT	TOTAL	---	C1
G	23-1-12	.178	.178	---	FRONT	VERT	TOTAL	---	C1
H	29-2-8	.542	.542	---	FRONT	VERT	TOTAL	---	C1
L	29-1-12	.38	.38	---	FRONT	VERT	TOTAL	---	C1
M	23-1-12	.38	.38	---	FRONT	VERT	TOTAL	---	C1
N	21-1-12	.38	.38	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	.38	.38	---	FRONT	VERT	TOTAL	---	C1
T	7-1-12	.178	.178	---	FRONT	VERT	TOTAL	---	C1
U	9-1-12	.178	.178	---	FRONT	VERT	TOTAL	---	C1
V	11-1-12	.178	.178	---	FRONT	VERT	TOTAL	---	C1
W	13-1-12	.178	.178	---	FRONT	VERT	TOTAL	---	C1
X	15-1-12	.178	.178	---	FRONT	VERT	TOTAL	---	C1
Y	17-1-12	.178	.178	---	FRONT	VERT	TOTAL	---	C1
Z	19-1-12	.178	.178	---	FRONT	VERT	TOTAL	---	C1
AA	21-1-12	.178	.178	---	FRONT	VERT	TOTAL	---	C1
AB	25-1-12	.178	.178	---	FRONT	VERT	TOTAL	---	C1
AC	27-1-12	.178	.178	---	FRONT	VERT	TOTAL	---	C1
AD	2-0-12	.38	.38	---	FRONT	VERT	TOTAL	---	C1
AE	4-0-12	.38	.38	---	FRONT	VERT	TOTAL	---	C1
AF	7-1-12	.38	.38	---	FRONT	VERT	TOTAL	---	C1
AG	9-1-12	.38	.38	---	FRONT	VERT	TOTAL	---	C1
AH	11-1-12	.38	.38	---	FRONT	VERT	TOTAL	---	C1
AI	13-1-12	.38	.38	---	FRONT	VERT	TOTAL	---	C1
AJ	15-1-12	.38	.38	---	FRONT	VERT	TOTAL	---	C1
AK	17-1-12	.38	.38	---	FRONT	VERT	TOTAL	---	C1
AL	19-1-12	.38	.38	---	FRONT	VERT	TOTAL	---	C1
AM	25-1-12	.38	.38	---	FRONT	VERT	TOTAL	---	C1
AN	27-1-12	.38	.38	---	FRONT	VERT	TOTAL	---	C1
AO	31-0-4	.38	.38	---	FRONT	VERT	TOTAL	---	C1
AP	33-0-4	.38	.38	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2008047 7/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408315	T2	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:33 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns11-z32zYGgy3V0n?K3m3vNcZ7HP7Q1YK(r19)zLa8

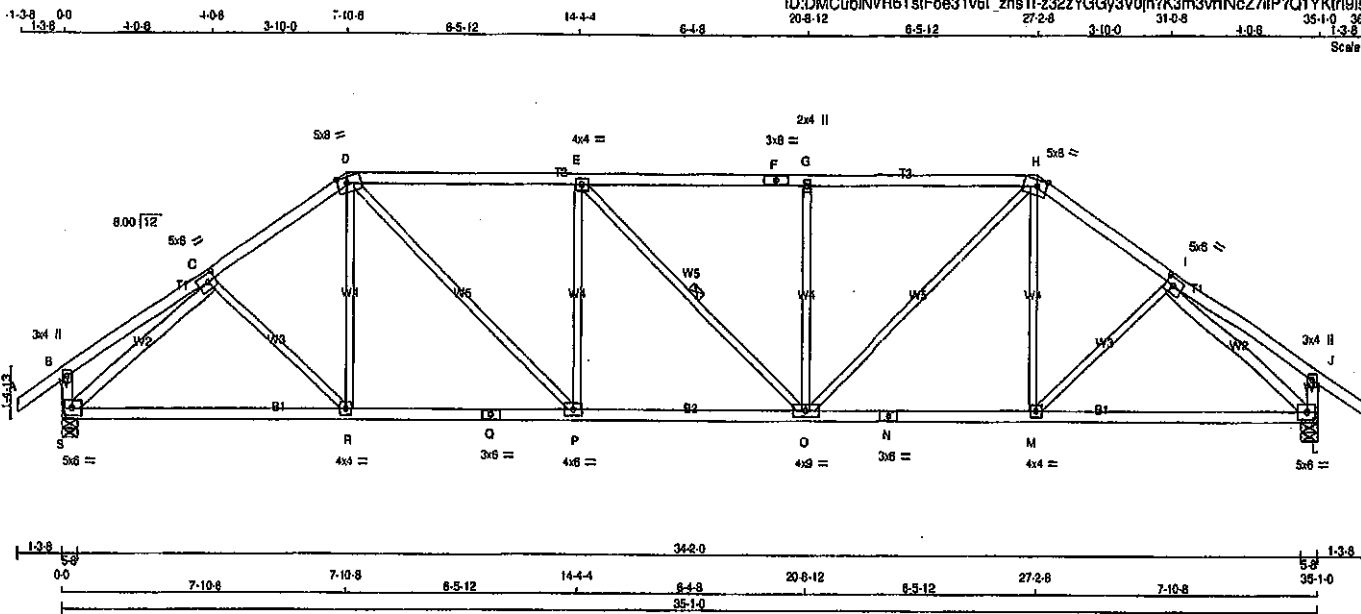


TOTAL WEIGHT = 161 lb
(M)

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-I	MT20	5.0	8.0	2.50	2.75
D	TTWW-m	MT20	5.0	8.0	2.00	3.25
E	TMWW-I	MT20	4.0	4.0		
F	TS-I	MT20	3.0	8.0		
G	TMW+w	MT20	2.0	4.0		
H	TTWW-m	MT20	5.0	8.0	2.00	3.25
I	TMWW-I	MT20	5.0	8.0	2.50	2.75
J	TMV+p	MT20	3.0	4.0		
L	BMWW-I	MT20	5.0	8.0	2.50	2.75
M	BS-I	MT20	4.0	4.0		
N	BS-I	MT20	3.0	8.0		
O	BMWW-I	MT20	4.0	4.0		
P	BS-I	MT20	4.0	4.0		
Q	BS-I	MT20	3.0	8.0		
R	BMWW-I	MT20	4.0	4.0		
S	BMWW-I	MT20	5.0	8.0	2.50	2.75

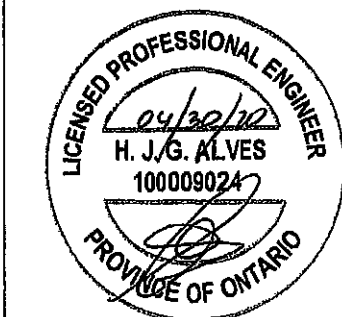

Structural component only
DWG# T-2008006

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
S	2060	0	2060	0	0	5-8	5-8
L	2060	0	2060	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST CASE		MAX/MIN COMPONENT REACTIONS		LIVE		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW
S	1454	968 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	487 / 0	0 / 0	0 / 0	0 / 0
L	1454	968 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	487 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. CSI (LC)	MAX. UNBRAC	MEMB.	FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO		LENGTH	FR-TO		
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	C-R	0 / 72	0.02 (4)
B-C	0 / 22	-91.8	-91.8 0.21 (1)	10.00	R-D	0 / 126	0.04 (4)
C-D	-2282 / 0	-91.8	-91.8 0.30 (1)	4.25	D-P	0 / 1071	0.24 (1)
D-E	-2844 / 0	-91.8	-91.8 0.78 (1)	3.47	E-O	-840 / 0	0.47 (1)
E-F	-2843 / 0	-91.8	-91.8 0.77 (1)	3.47	O-E	-2 / 0	0.00 (1)
F-G	-2843 / 0	-91.8	-91.8 0.77 (1)	3.47	O-G	-840 / 0	0.47 (1)
G-H	-2843 / 0	-91.8	-91.8 0.77 (1)	3.49	O-H	0 / 1089	0.24 (1)
H-I	-2282 / 0	-91.8	-91.8 0.30 (1)	4.25	M-H	0 / 126	0.04 (4)
I-J	0 / 22	-91.8	-91.8 0.21 (1)	10.00	M-I	0 / 72	0.02 (4)
J-K	0 / 35	-91.8	-91.8 0.12 (1)	10.00	S-C	-2527 / 0	0.86 (1)
S-B	-287 / 0	0.0	0.0 0.03 (1)	7.81	I-L	-2527 / 0	0.86 (1)
L-J	-287 / 0	0.0	0.0 0.03 (1)	7.81			
S-R	0 / 1840	-18.5	-18.5 0.44 (1)	10.00			
R-Q	0 / 1879	-18.5	-18.5 0.45 (1)	10.00			
Q-P	0 / 1879	-18.5	-18.5 0.45 (1)	10.00			
P-O	0 / 2845	-18.5	-18.5 0.49 (1)	10.00			
O-N	0 / 1880	-18.5	-18.5 0.45 (1)	10.00			
N-M	0 / 1880	-18.5	-18.5 0.45 (1)	10.00			
M-L	0 / 1840	-18.5	-18.5 0.44 (1)	10.00			


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408315	T3	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Thu Apr 30 09:31:34 2020 Page 1

ID:DMCubINVR6TstFo831v6l_zns11-RFclbGaqp8aP9vFKnQ0wp5HN3mX9bDT6V2ElzLa77

Scale = 1:57.6

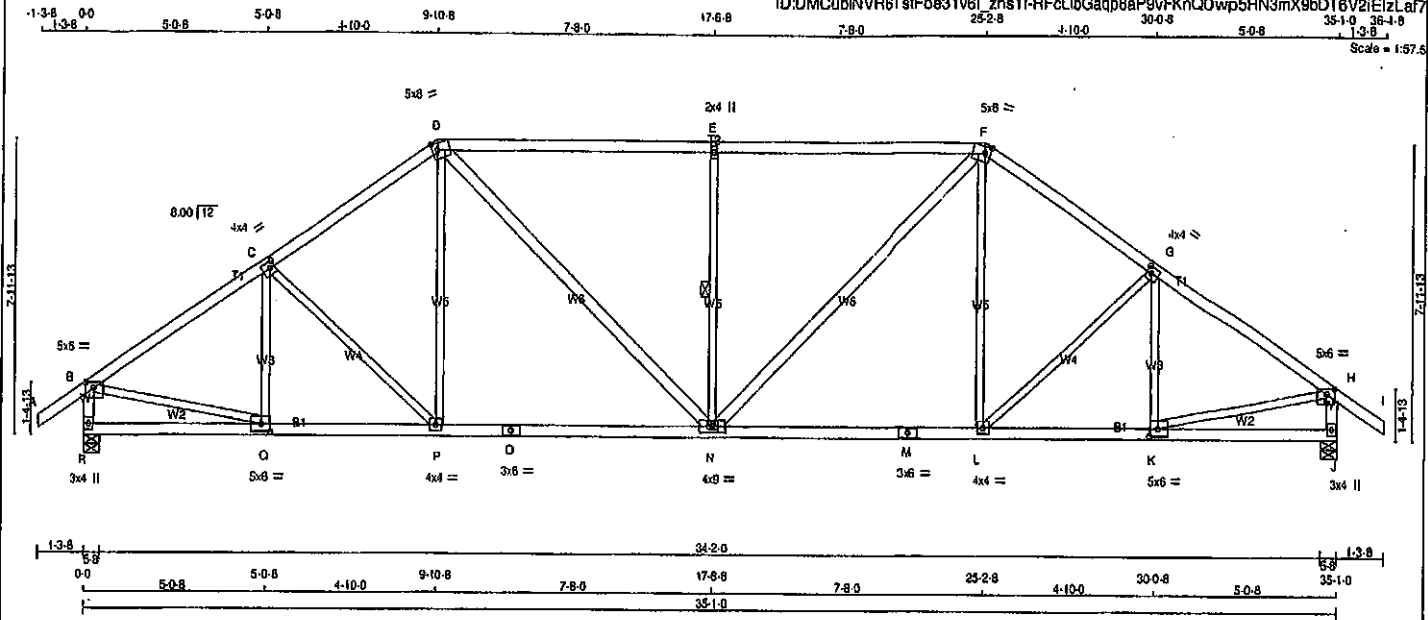

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	X
B	TMWV-p	MT20	5.0	8.0	1.75 2.75
C	TMWW-l	MT20	4.0	4.0	2.00 1.50
D	TTWW-m	MT20	5.0	8.0	2.25 1.75
E	TMW-w	MT20	2.0	4.0	
F	TTWW-m	MT20	5.0	8.0	2.25 1.75
G	TMWW-l	MT20	4.0	4.0	2.00 1.50
H	TMWV-p	MT20	5.0	8.0	1.75 2.75
J	BMV-l-p	MT20	3.0	4.0	
K	BMWV-l	MT20	5.0	8.0	2.50 2.75
L	BMWW-l	MT20	4.0	4.0	
M	BS-l	MT20	3.0	6.0	
N	BMWWW-l	MT20	4.0	9.0	
O	BS-l	MT20	3.0	6.0	
P	BMWV-l	MT20	3.0	4.0	
Q	BMWW-l	MT20	5.0	8.0	2.50 2.75
R	BMV-l-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED				MAXIMUM FACTORED			
GROSS REACTION				BRG			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
R	2080	0	2080	0	0	5-8	5-8
J	2080	0	2080	0	0	5-8	5-8

UNFACTORED REACTIONS							
1ST CASE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1454	988 / 0	0 / 0	0 / 0	0 / 0	487 / 0	0 / 0
J	1454	988 / 0	0 / 0	0 / 0	0 / 0	487 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.36 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	UNBRACED LENGTH
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	Q-C	-329 / 0	0.11 (1)	10.00
B-C	-2307 / 0	-91.8	-91.8 0.37 (1)	C-P	-202 / 0	0.16 (1)	4.19
C-D	-2188 / 0	-91.8	-91.8 0.35 (1)	P-D	0 / 257	0.08 (4)	4.20
D-E	-2302 / 0	-91.8	-91.8 0.85 (1)	D-N	0 / 716	0.12 (1)	3.38
E-F	-2302 / 0	-91.8	-91.8 0.85 (1)	N-E	-867 / 0	0.35 (1)	3.38
F-G	-2188 / 0	-91.8	-91.8 0.35 (1)	N-F	0 / 716	0.12 (1)	4.20
G-H	-2307 / 0	-91.8	-91.8 0.37 (1)	L-F	0 / 257	0.06 (4)	4.19
H-I	0 / 35	-91.8	-91.8 0.12 (1)	L-G	-202 / 0	0.16 (1)	10.00
R-B	-2017 / 0	0.0	0.0 0.21 (1)	K-G	-329 / 0	0.11 (1)	5.94
J-H	-2017 / 0	0.0	0.0 0.21 (1)	B-Q	0 / 1988	0.45 (1)	5.94
R-Q	0 / 0	-18.5	-18.5 0.10 (4)	K-H	0 / 1988	0.45 (1)	10.00
Q-P	0 / 1944	-18.5	-18.5 0.40 (1)				
P-O	0 / 1797	-18.5	-18.5 0.41 (1)				
O-N	0 / 1797	-18.5	-18.5 0.41 (1)				
N-M	0 / 1797	-18.5	-18.5 0.41 (1)				
M-L	0 / 1797	-18.5	-18.5 0.41 (1)				
L-K	0 / 1944	-18.5	-18.5 0.40 (1)				
K-J	0 / 0	-18.5	-18.5 0.10 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.117)
CALCULATED VERT. DEFL.(LL) = U/989 (0.117)
ALLOWABLE DEFL.(TL) = L/360 (0.117)
CALCULATED VERT. DEFL.(TL) = U/989 (0.22)

CSI: TC=0.85/1.00 (E-F:1), BC=0.41/1.00 (N-P:1), WB=0.45/1.00 (B-Q:1), SS=0.34/1.00 (E-F:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (B) (INPUT = 0.50)
JSI METAL= 0.59 (C) (INPUT = 1.00)

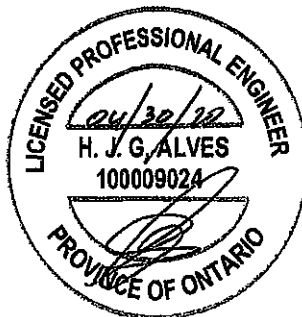


Structural component only
DWG# T-2008007

JOB NAME 408315	TRUSS NAME T4	QUANTITY 1	PLY 3	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	----------

Famarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Thu Apr 30 11:19:20 2020 Page 1

ID:DMCubINVR8tstFoe31v6L_zns11-7CJlqYXU4Uo7rDz6lQJ_MvRGYVC9phCyTLiAXzLZ45

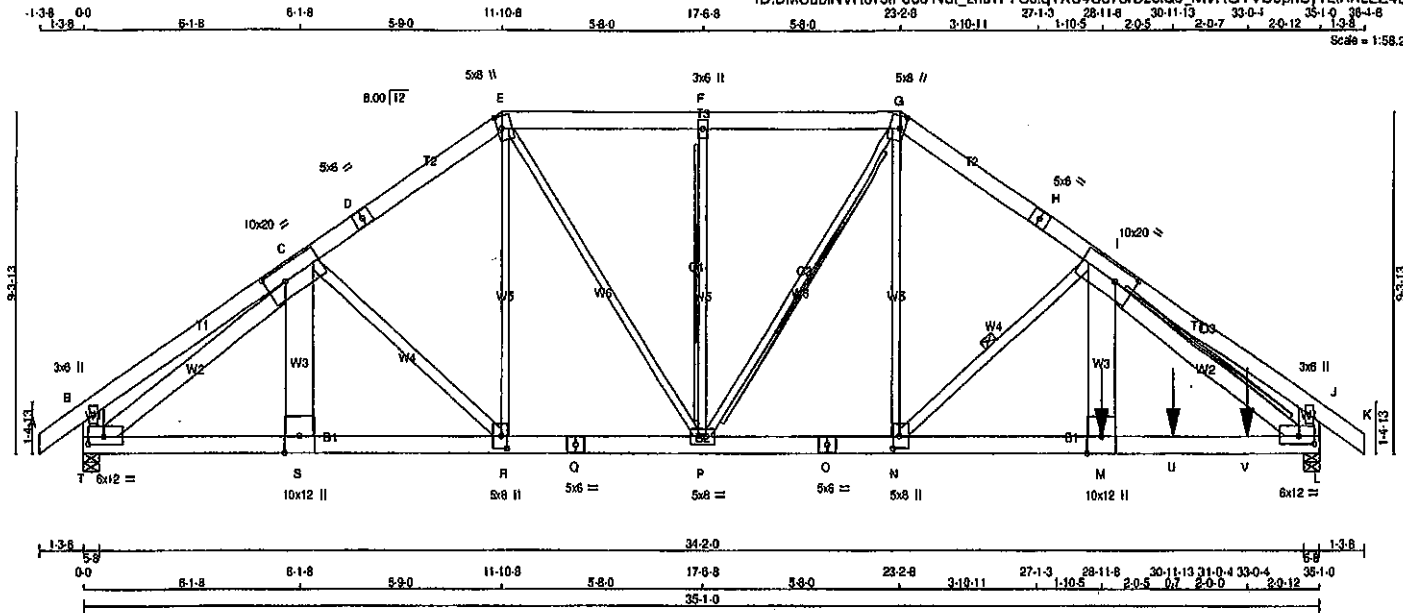

TOTAL WEIGHT = 3 X 250 = 750 LB

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x8	DRY	No.2	SPF		
E - H	2x8	DRY	No.2	SPF		
I - K	2x8	DRY	No.2	SPF		
L - J	2x8	DRY	No.2	SPF		
T - B	2x8	DRY	No.2	SPF		
Q - O	2x8	DRY	1850F 1.5E	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						
S - C	2x10	DRY	No.2	SPF		
C - R	2x4	DRY	No.2	SPF		
N - I	2x4	DRY	No.2	SPF		
T - C	2x6	DRY	No.2	SPF		
M - I	2x10	DRY	No.2	SPF		
I - L	2x6	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 3 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-D 2	12	TOP
E-H 2	12	TOP
I-K 2	12	TOP
L-J 2	12	TOP
T-B 2	12	TOP
Q-O 2	12	TOP
Q-L 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
T-Q 2	7	TOP
Q-O 2	12	TOP
Q-L 2	7	SIDE(648.3)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	
2x4 1	6	
2x6 2	6	
I-M 5	4	SIDE(3445.0)
2x10 5	4	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORIZ	DOWN	HORIZ
T	4365	0	4365	0
L	14398	0	14398	0

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM	LIVE
T	3082	2051	0	0	0
L	10166	6764	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.71 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF I-M
2x6 DRY SPF NO.2 T-BRACE AT F-P, G-P, I-L

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LG1 (PLF)	MAX. FACTORED CSI (LC)	MAX. FACTORED UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO					FR-TO		
A-B	0.738	-81.8	-81.8	0.02 (1)	S-C	0.128	0.01 (4)
B-C	0.729	-81.8	-81.8	0.07 (1)	C-R	-33.0	0.01 (1)
C-D	-5831.0	-81.8	-81.8	0.10 (1)	E-P	0.122	0.01 (4)
D-E	-5831.0	-81.8	-81.8	0.10 (1)	E-P	0.3162	0.24 (1)
E-F	-5827.0	-81.8	-81.8	0.09 (1)	P-F	-589.0	0.09 (1)
F-G	-5827.0	-81.8	-81.8	0.09 (1)	P-Q	-2201.0	0.52 (1)
G-H	-9190.0	-81.8	-81.8	0.17 (1)	N-G	0.8480	0.48 (1)
H-I	-9190.0	-81.8	-81.8	0.17 (1)	N-I	-10507.0	0.94 (1)
I-J	-8.0	-81.8	-81.8	0.10 (1)	T-C	-6246.0	0.87 (1)
J-K	0.738	-81.8	-81.8	0.02 (1)	M-I	0.13739	0.38 (1)
T-B	-358.0	0.0	0.0	0.01 (1)	I-L	-20028.0	0.96 (1)
L-J	-421.0	0.0	0.0	0.01 (1)			
T-S	0.4843	-18.5	-18.5	0.14 (1)			
S-R	0.4844	-18.5	-18.5	0.13 (1)			
R-Q	0.4820	-18.5	-18.5	0.15 (1)			
Q-P	0.4820	-18.5	-18.5	0.15 (1)			
P-O	0.7715	-18.5	-18.5	0.25 (1)			
O-N	0.7715	-18.5	-18.5	0.25 (1)			
N-M	0.15707	-18.5	-18.5	0.58 (1)			
M-U	0.15528	-18.5	-18.5	0.80 (1)			
U-V	0.15528	-18.5	-18.5	0.80 (1)			
V-L	0.15528	-18.5	-18.5	0.80 (1)			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
M	28-11-8	-11723	-11723	---	BACK	VERT	TOTAL	---	C1
U	31-0-4	-1456	-1456	---	BACK	VERT	TOTAL	---	C1
V	33-0-4	-1456	-1456	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = U/999 (0.15')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = U/999 (0.28')

CSI: TC=0.17/1.00 (G-I), BC=0.80/1.00 (L-M), WB=0.98/1.00 (I-L), SS=0.34/1.00 (L-M)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSB) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (R) (INPUT = 0.90)
JSI METAL= 0.96 (R) (INPUT = 1.00)



Structural component only
DWG# T-2008008 1/2

CONTINUED ON PAGE 2

JOB NAME 408315	TRUSS NAME T4	QUANTITY 1	PLY 3	JOB DESC. GREEN PARK HOMES	DRWG NO.
Famareck Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 11:19:20 2020 Page 2

ID:DMCubINVR8TsFoe31v6I zns1I-7CJqYXU4Uo78rDz8IQJ MvRGYVC9phCvTLiAXdLZ45

STAGGER NAILS BY HALF THE SURFACE SPACING IN ADJACENT PLIES.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	8.0		
C	TMVWW-i	MT20	10.0	20.0	4.75	6.75
D	TS-i	MT20	5.0	8.0		
E	TTWW+m	MT20	5.0	8.0	4.00	1.50
F	TMV+w	MT20	3.0	6.0		
G	TTWW+m	MT20	5.0	8.0	4.00	1.50
H	TS-i	MT20	5.0	6.0		
I	TMVWW-t	MT20	10.0	20.0	4.75	6.75
J	TMV+p	MT20	3.0	6.0		
L	BMVW1-i	MT20	6.0	12.0	2.50	5.50
M	BMV+w	MT20	10.0	12.0	Edge	
N	BMVW+i	MT20	5.0	8.0	4.00	2.00
O	BS-i	MT20	5.0	6.0		
P	BMVWW-i	MT20	5.0	8.0		
Q	BS-i	MT20	5.0	6.0		
R	BMVW+i	MT20	5.0	8.0	4.00	2.00
S	BMV+w	MT20	10.0	12.0	Edge	
T	BMVW1-i	MT20	6.0	12.0	2.50	5.50

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.




Structural component only
DWG# T-2008008

2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	T5	6	1	GREEN PARK HOMES	
TRUSS DESC.					

(amarack Roof Truss, Burlington)

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:37 2020 Page 1
ID:DMCubINVR6TslFoe31v6l_zns11-sqITodJT7kX8Gddq?v_jY5qjGoxMrfoSGNrdzLat4

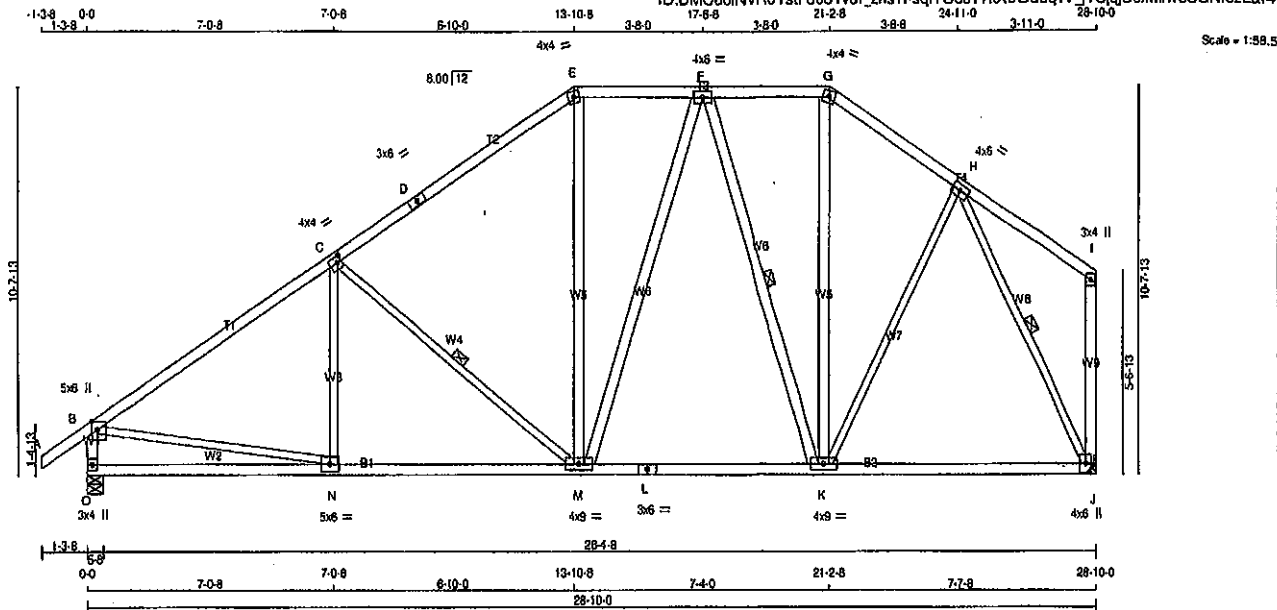

TOTAL WEIGHT = 6 X 158 = 948 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - G	2x4	DRY	No.2	SPF	
G - I	2x4	DRY	No.2	SPF	
O - B	2x4	DRY	No.2	SPF	
J - I	2x4	DRY	No.2	SPF	
O - L	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
ALL WEBS	2x4	DRY	No.2	SPF	
EXCEPT					
N - C	2x3	DRY	No.2	SPF	
C - M	2x3	DRY	No.2	SPF	
K - H	2x3	DRY	No.2	SPF	
B - N	2x3	DRY	No.2	SPF	
H - J	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMW+p	MT20	5.0	6.0	2.75	2.00
C	TMW-l	MT20	4.0	4.0	2.00	1.50
D	TS-t	MT20	3.0	8.0		
E	TTW-m	MT20	4.0	4.0		
F	TMW-l	MT20	4.0	6.0		
G	TTW-m	MT20	4.0	4.0		
H	TMW-l	MT20	4.0	6.0		
I	TMW-p	MT20	3.0	4.0		
J	BMW1+p	MT20	4.0	6.0		
K	BMW1-l	MT20	4.0	6.0		
L	BS-t	MT20	3.0	8.0		
M	BMW1-l	MT20	4.0	6.0		
N	BMW1-l	MT20	5.0	6.0		
O	BMW1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
O	1715	0	1715	0
J	1589	0	1589	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3'-8".

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM	LIVE	WIND	DEAD	SOIL	
O	1211	808 / 0	0 / 0	0 / 0	0 / 0	0 / 0	403 / 0	0 / 0	
J	1124	738 / 0	0 / 0	0 / 0	0 / 0	0 / 0	386 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLINE SPACING = 4.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-M, F-K, H-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FORCE	VERT. LOAD	MEMB.	MAX. FACTORED	FORCE	MAX.
		(LBS)	(PLF)			(LBS)	CSI(LC)
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	N-C	-97 / 84	0.08 (1)
B-C	-1848 / 0	-91.8	-91.8 0.72 (1)	4.08	C-M	-807 / 0	0.34 (1)
C-D	-1374 / 0	-91.8	-91.8 0.64 (1)	4.88	M-E	0 / 372	0.08 (1)
D-E	-1374 / 0	-91.8	-91.8 0.64 (1)	4.88	M-F	0 / 143	0.02 (1)
E-F	-1111 / 0	-91.8	-91.8 0.18 (1)	5.83	F-K	-572 / 0	0.37 (1)
F-G	-881 / 0	-91.8	-91.8 0.16 (1)	6.25	K-G	0 / 322	0.05 (1)
G-H	-1078 / 0	-91.8	-91.8 0.17 (1)	5.89	K-H	0 / 422	0.09 (1)
H-I	0 / 22	-91.8	-91.8 0.21 (1)	10.00	B-N	0 / 1592	0.38 (1)
O-B	-1862 / 0	0.0	0.0 0.17 (1)	6.43	H-J	-1555 / 0	0.79 (1)
J-I	-137 / 0	0.0	0.0 0.08 (1)	7.81			
O-N	0 / 0	-18.5	-18.5 0.22 (4)	10.00			
N-M	0 / 1573	-18.5	-18.5 0.37 (1)	10.00			
M-L	0 / 1085	-18.5	-18.5 0.35 (4)	10.00			
L-K	0 / 1085	-18.5	-18.5 0.35 (4)	10.00			
K-J	0 / 887	-18.5	-18.5 0.32 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.96")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.96")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

OS: TO=0.72/1.00 (B-C:1), RC=0.37/1.00 (M-N:1), WB=0.79/1.00 (H-J:1), SS=0.28/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1868

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.80 (B) (INPUT = 0.80)
JSI METAL= 0.77 (B) (INPUT = 1.00)

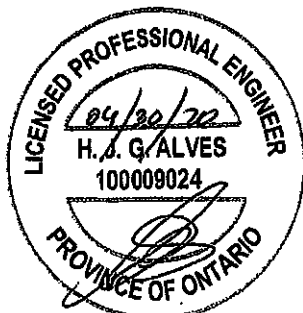

Structural component only
DWG# T-2008009




Structural component only
DWG# T-2008010

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	T7	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 09:31:40 2020 Page 1

ID:DMCubINVR6TsFoe31v6I_zns11-GPzc0fLLQm74MPq1XQA4LKZUqJZJ5MUQV1RyzLaf1

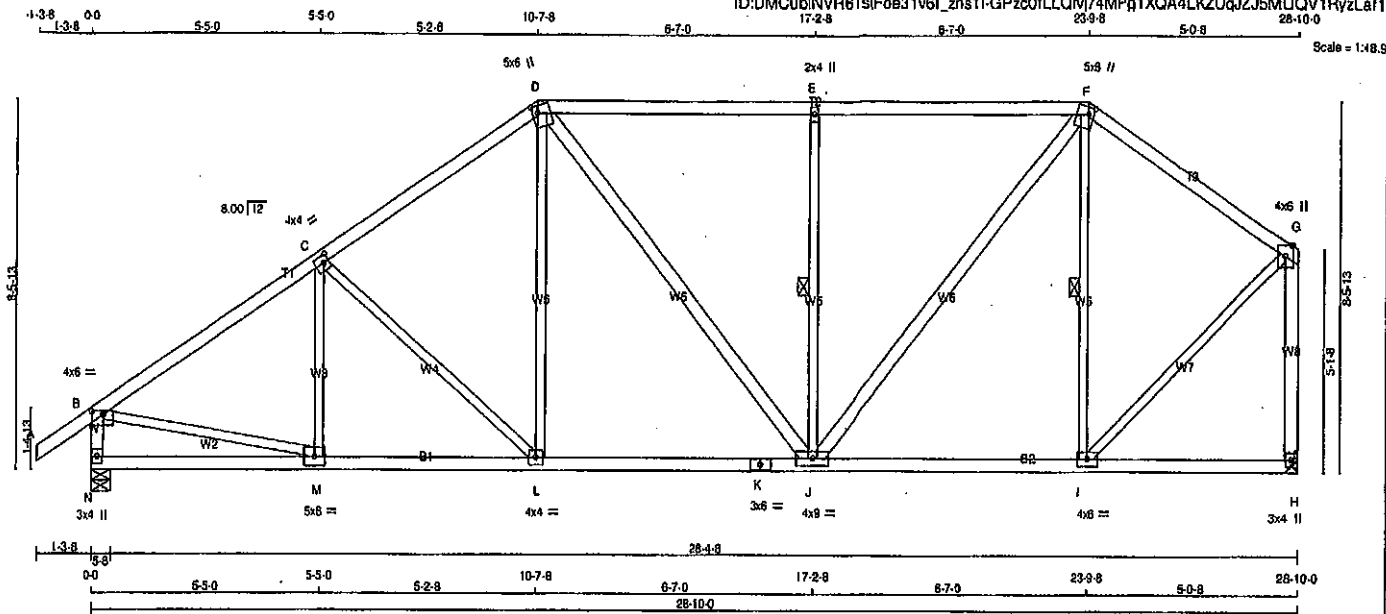

LUMBER				N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF			
D - F	2x4	DRY	No.2	SPF			
F - G	2x4	DRY	No.2	SPF			
N - B	2x4	DRY	No.2	SPF			
H - G	2x4	DRY	No.2	SPF			
N - K	2x4	DRY	No.2	SPF			
K - H	2x4	DRY	No.2	SPF			
ALL WEBS	2x3	DRY	No.2	SPF			
EXCEPT							
D - J	2x4	DRY	No.2	SPF			
J - F	2x4	DRY	No.2	SPF			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A - B	TMVW-p	MT20	4.0	8.0	1.00 3.25
B - C	TMVW-l	MT20	4.0	4.0	2.00 1.50
D - E	TTWW+m	MT20	5.0	8.0	2.00 1.50
E - F	TMVW-w	MT20	2.0	4.0	
F - G	TTWW+m	MT20	5.0	8.0	2.00 1.50
G - H	TMVW-p	MT20	4.0	8.0	Edge
H - I	BMVW-l	MT20	3.0	4.0	
I - J	BMVW-l	MT20	4.0	8.0	
J - K	BMVW-l	MT20	4.0	9.0	
K - L	BS-l	MT20	3.0	6.0	
L - M	BMVW-l	MT20	4.0	4.0	
M - N	BMVW-l	MT20	5.0	6.0	
N - O	BMVW-l	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
N	1715	0	1715	0
H	1589	0	1589	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
N	1211	808 / 0	0 / 0	0 / 0	0 / 0	403 / 0	0 / 0
H	1124	738 / 0	0 / 0	0 / 0	0 / 0	386 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.54 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-J, F-I.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	M-C	-209 / 15	0.08 (1)
B-C	-1848 / 0	-91.8	-91.8 0.39 (1)	4.54	C-L	-343 / 0	0.33 (1)
C-D	-1606 / 0	-91.8	-91.8 0.37 (1)	4.83	L-D	0 / 338	0.08 (1)
D-E	-1412 / 0	-91.8	-91.8 0.55 (1)	4.77	D-J	0 / 162	0.03 (1)
E-F	-1412 / 0	-91.8	-91.8 0.55 (1)	4.77	J-E	-745 / 0	0.34 (1)
F-G	-993 / 0	-91.8	-91.8 0.31 (1)	5.87	J-F	0 / 850	0.15 (1)
N-B	-1672 / 0	0.0	0.0 0.17 (1)	6.42	I-F	-650 / 0	0.30 (1)
H-G	-1554 / 0	0.0	0.0 0.74 (1)	8.81	B-M	0 / 1595	0.38 (1)
N-M	0 / 0	-18.5	-18.5 0.11 (4)	10.00	I-G	0 / 1129	0.25 (1)
M-L	0 / 1584	-18.5	-18.5 0.32 (1)	10.00			
L-K	0 / 1311	-18.5	-18.5 0.29 (1)	10.00			
K-J	0 / 1311	-18.5	-18.5 0.29 (1)	10.00			
J-I	0 / 817	-18.5	-18.5 0.23 (4)	10.00			
I-H	0 / 0	-18.5	-18.5 0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 8.0	PSF
BOT CH.	LL	= 6.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 8, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 8 OF NBC 2010, OBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.98")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (0.98")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CS: TC=0.74/1.00 (G-H:1), BC=0.32/1.00 (L-M:1), WB=0.38/1.00 (B-M:1), SS=0.29/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	818 354 1687 788 1987 1656	


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.52 (G) (INPUT = 1.00)

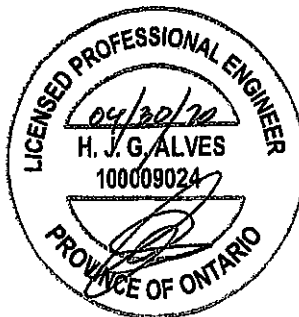

Structural component only
DWG# T-2008011

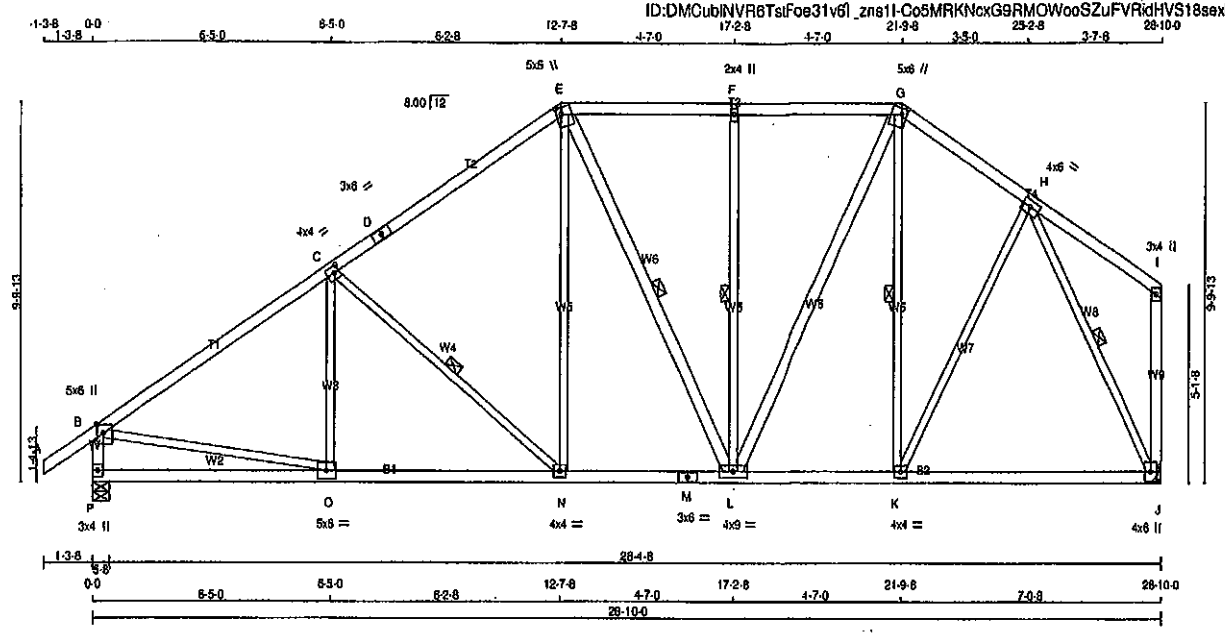

Scale = 1:50.1

TOTAL WEIGHT = 153 lb (MRF)

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
I - J	2x4	DRY	No.2	SPF
P - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
E - L	2x4	DRY	No.2	SPF
L - G	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW+p	MT20	5.0	6.0	2.75	2.00
C	TMWW-i	MT20	4.0	4.0	2.00	1.50
D	TS-i	MT20	3.0	6.0		
E	TTWW+m	MT20	5.0	8.0	2.00	1.50
F	TMWW+w	MT20	2.0	4.0		
G	TTWW+m	MT20	5.0	8.0	2.00	1.50
H	TMWW-i	MT20	4.0	6.0		
I	TMV+p	MT20	3.0	4.0		
J	BMVW-i+p	MT20	4.0	8.0		
K	BMVW-i	MT20	4.0	4.0		
L	BMVWW-i	MT20	4.0	9.0		
M	BS-i	MT20	3.0	6.0		
N	BMVW-i	MT20	4.0	4.0		
O	BMVW-i	MT20	5.0	8.0		
P	BMVW-i+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN
P	1715	0	0
J	1589	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW
P	1211	808 / 0
J	1124	738 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.29 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.
1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, E-L, F-L, G-K, H-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	Q-C	-134 / 61	0.07 (1)
B-C	-1855 / 0	-91.8	-91.8 0.58 (1)	4.29	C-N	-510 / 0	0.24 (1)
C-D	-1487 / 0	-91.8	-91.8 0.52 (1)	4.77	N-E	0 / 435	0.10 (1)
D-E	-1467 / 0	-91.8	-91.8 0.52 (1)	4.77	E-L	-23 / 0	0.01 (4)
E-F	-1182 / 0	-91.8	-91.8 0.26 (1)	5.68	L-F	-512 / 0	0.33 (1)
F-G	-1182 / 0	-91.8	-91.8 0.26 (1)	5.58	L-G	0 / 653	0.10 (1)
G-H	-1107 / 0	-91.8	-91.8 0.15 (1)	5.85	K-G	-268 / 0	0.17 (1)
H-I	0 / 21	-91.8	-91.8 0.18 (1)	10.00	K-H	0 / 454	0.10 (1)
I-J	-1868 / 0	0.0	0.0 0.17 (1)	6.42	B-O	0 / 1598	0.38 (1)
P-B	-126 / 0	0.0	0.0 0.08 (1)	7.81	H-J	-1573 / 0	0.86 (1)
J-I	-126 / 0	0.0	0.0 0.08 (1)	7.81			
P-O	0 / 0	-18.5	-18.5 0.18 (4)	10.00			
O-N	0 / 1576	-18.5	-18.5 0.34 (1)	10.00			
N-M	0 / 1191	-18.5	-18.5 0.25 (1)	10.00			
M-L	0 / 1191	-18.5	-18.5 0.25 (1)	10.00			
L-K	0 / 889	-18.5	-18.5 0.28 (4)	10.00			
K-J	0 / 699	-18.5	-18.5 0.26 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF RCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.98")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.98")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.58/1.00 (B-C:1), SC=0.34/1.00 (N-O:1), WB=0.68/1.00 (H-J:1), SI=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1650

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.89 (B) (INPUT = 0.90)
JSI METAL= 0.77 (B) (INPUT = 1.00)

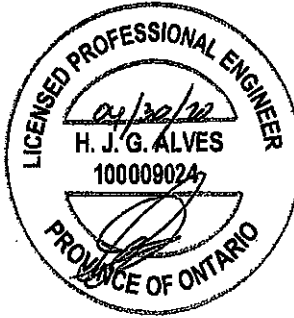

Structural component only
DWG# T-2008012

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	T9	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:43 2020 Page 1
ID:DMCubINVR6TsfFoe31v6l_zns11-q_flegNElaHl_Y5_MA47nizqmhg?mYHoAOjh2HzLaf

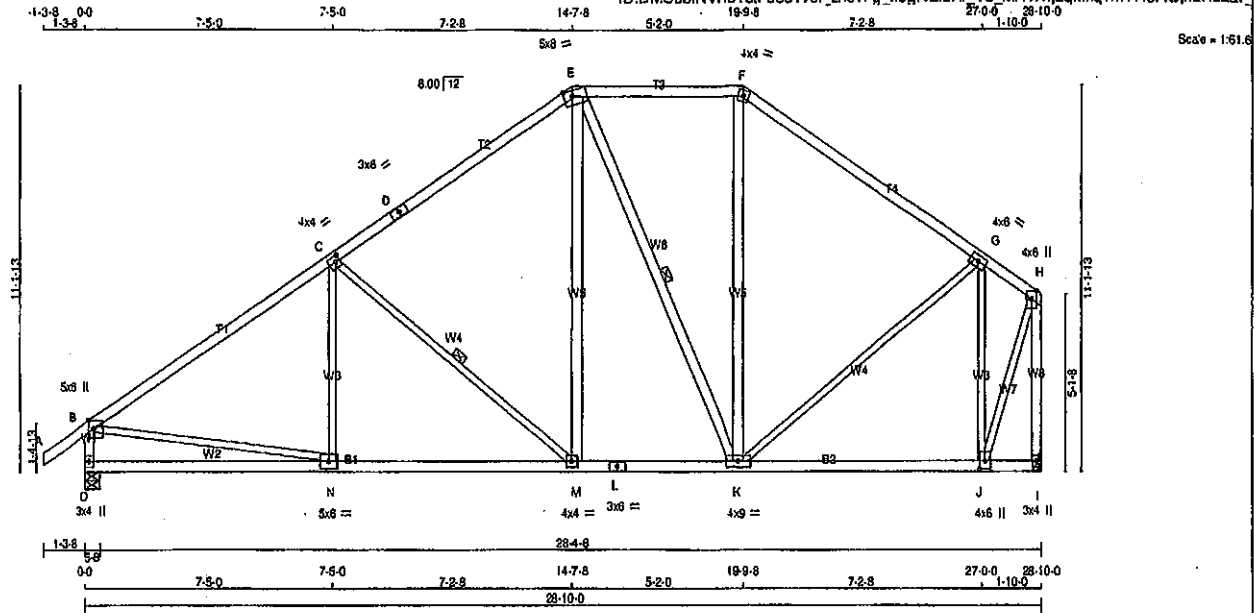

TOTAL WEIGHT = 4 X 151 = 605 lb (M/F)

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
O - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
O - L	2x4	DRY	No.2
L - I	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
M - E	2x4	DRY	No.2
E - K	2x4	DRY	No.2
K - F	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	5.0	6.0	2.75	2.00
C TMVW-l	MT20	4.0	4.0	2.00	1.50
D TS-l	MT20	3.0	6.0		
E TTWW-m	MT20	5.0	6.0	2.00	3.00
F TTWW-m	MT20	4.0	4.0		
G TMVW-l	MT20	4.0	6.0		
H TMVW+p	MT20	4.0	6.0	Edge	
I BMVl+p	MT20	3.0	4.0		
J BMVW+l	MT20	4.0	6.0	2.75	2.00
K BMVW+l	MT20	4.0	6.0		
L BS-l	MT20	3.0	6.0		
M BMVW-l	MT20	4.0	4.0		
N BMVW-l	MT20	5.0	6.0		
O BMVl+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	SRG
O	1211	0	1715	0	0
I	1589	0	1589	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3'-8".

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
O	1211	808 / 0	0 / 0	0 / 0	0 / 0	403 / 0	0 / 0
I	1124	739 / 0	0 / 0	0 / 0	0 / 0	388 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.91 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-M, E-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0 / 35	N-C	-72 / 101
B-C	-1842 / 0	C-M	-687 / 0
C-D	-1314 / 0	M-E	0 / 525
D-E	-1314 / 0	E-K	-335 / 0
E-F	-921 / 0	K-F	0 / 119
F-G	-1141 / 0	G-K	0 / 490
G-H	-509 / 0	J-G	-1297 / 0
H-B	-1660 / 0	B-N	0 / 1587
I-H	-1808 / 0	J-H	0 / 1514
O-N	0 / 0		
N-M	0 / 1570		
M-L	0 / 1081		
L-K	0 / 1061		
K-J	0 / 540		
J-I	0 / 0		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.96")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (0.96")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.81/1.00 (B-C:1), BC=0.39/1.00 (M-N:1), WB=0.84/1.00 (B-J:1), SS=0.27/1.00 (B-C:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (B) (INPUT = 0.90)

JSI METAL = 0.77 (B) (INPUT = 1.00)

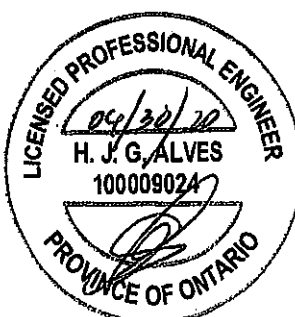


Structural component only
DWG# T-2008013

JOB NAME 408315	TRUSS NAME T10	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:45 2020 Page 1

ID:DMCubINVR6TstFos31v6l_zns11-dMmV3MPUEBX0dEMTa7b183EvVR3EWp5eCo6AZLaay



LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - G	2x6	DRY	No.2
G - J	2x6	DRY	No.2
J - L	2x4	DRY	No.2
X - B	2x6	DRY	No.2
M - K	2x6	DRY	No.2
X - U	2x6	DRY	No.2
U - P	2x6	DRY	No.2
P - M	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
J - L	12	TOP
C - G	12	SIDE(0.0)
G - J	12	TOP
X - B	12	TOP
M - K	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
X - U	12	TOP
U - P	12	SIDE(183.1)
P - M	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
T - E	6	SIDE(237.8)
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PILES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORIZ	DOWN	HORIZ	UPLIFT	IN-SX	IN-SX	BRG
X	4128	0	4128	0	0	5-8	5-8		
M	3945	0	3945	0	0	5-8	5-8		

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN	COMPONENT REACTIONS
X	2908	1970 / 0	0 / 0
M	2780	1881 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) X, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD LG1	MAX. CS1 (LG)	MEMB.	FORCE (LBS)	MAX. CS1 (LG)	MAX. CS1 (LG)
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8	0.07 (1)	10.00	-681 / 0	0.14 (1)
B-C	-5286 / 0	-91.8	-91.8	0.57 (1)	3.79	-828 / 0	0.12 (1)
C-D	-6908 / 0	-91.8	-91.8	0.13 (1)	4.49	-8 / 4472	0.55 (1)
D-E	-9033 / 0	-91.8	-91.8	0.19 (1)	3.86	-8 / 4253	0.53 (1)
E-F	-9338 / 0	-91.8	-91.8	0.25 (1)	3.83	-462 / 0	0.10 (1)
F-G	-9418 / 0	-91.8	-91.8	0.20 (1)	3.87	-209 / 0	0.04 (1)
G-H	-9418 / 0	-91.8	-91.8	0.20 (1)	3.87	-2292 / 0	0.43 (1)
H-I	-8557 / 0	-91.8	-91.8	0.18 (1)	4.06	-8 / 2176	0.27 (1)
I-J	-8544 / 0	-91.8	-91.8	0.12 (1)	4.60	-8 / 773	0.10 (1)
J-K	-5026 / 0	-91.8	-91.8	0.55 (1)	3.89	-8 / 4083	0.90 (1)
K-L	0 / 35	-91.8	-91.8	0.07 (1)	10.00	-3073 / 0	0.58 (1)
X-B	-4074 / 0	0.0	0.0	0.15 (1)	7.05	-8 / 3408	0.42 (1)
M-K	-3894 / 0	0.0	0.0	0.14 (1)	7.18	-8 / 3824	0.47 (1)
X-W	0 / 0	-18.5	-18.5	0.04 (4)	10.00	-2956 / 0	0.58 (1)
W-V	0 / 4421	-18.5	-18.5	0.30 (1)	10.00	-8 / 3223	0.40 (1)
V-U	0 / 6908	-18.5	-18.5	0.52 (1)	10.00		
U-T	0 / 6908	-18.5	-18.5	0.52 (1)	10.00		
T-S	0 / 9033	-18.5	-18.5	0.68 (1)	10.00		
S-Z	0 / 9480	-18.5	-18.5	0.73 (1)	10.00		
Z-R	0 / 9480	-18.5	-18.5	0.73 (1)	10.00		
R-Q	0 / 8557	-18.5	-18.5	0.67 (1)	10.00		
Q-P	0 / 6844	-18.5	-18.5	0.44 (1)	10.00		
P-O	0 / 6844	-18.5	-18.5	0.44 (1)	10.00		
O-N	0 / 4204	-18.5	-18.5	0.29 (1)	10.00		
N-M	0 / 0	-18.5	-18.5	0.04 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	17-5-12	-178	-178		BACK	VERT	TOTAL		C1
R	18-8-8	-1986	-1986		BACK	VERT	TOTAL		C1
S	15-5-12	-36	-36		BACK	VERT	TOTAL		C1
T	13-8-8	-1613	-1613		BACK	VERT	TOTAL		C1
Y	15-5-12	-178	-178		BACK	VERT	TOTAL		C1
Z	17-5-12	-36	-36		BACK	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2010
- PART 9 OF OBC 2012 (2015 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.15")
CALCULATED VERT. DEFL.(LL) = L/999 (0.20")
ALLOWABLE DEFL.(TL) = L/360 (1.15")
CALCULATED VERT. DEFL.(TL) = L/999 (0.36")

CSI: TC=0.57/1.00 (B-C:1), BC=0.73/1.00 (R-S:1), WB=0.58/1.00 (D-V:1), SSI=0.10/1.00 (J-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENG=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1607 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (E) (INPUT = 0.90)
JSI METAL = 0.65 (U) (INPUT = 1.00)



Structural component only
DWG# T-2008014 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408315	T10	1	2	TRUSS DESC.		

Tomarack Roof Truss, Burlington


Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 09:31:45 2020 Page 2

ID:DMCubINVR6TsIFos31v6I zng11-dMmV3MPUEBX0DreMTa7b183EvVR3EWp5eiCo6AzLaev

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	5.0	8.0	Edge	
C	TTWW+m	MT20	5.0	8.0	Edge	
D	TMWW-t	MT20	5.0	6.0		
E, F, H						
E	TMWW-t	MT20	5.0	6.0		
G	TS-t	MT20	5.0	6.0		
I	TMWW-t	MT20	5.0	6.0		
J	TTWW+m	MT20	5.0	8.0	Edge	
K	TMWW-p	MT20	5.0	8.0	Edge	
M	BMV1+p	MT20	3.0	6.0		
N	BMWW-t	MT20	5.0	6.0	2.50	2.50
O	BMWW-t	MT20	5.0	6.0	3.00	2.00
P	BS-t	MT20	5.0	6.0		
Q	BMWW-t	MT20	5.0	6.0		
R	BMWW-t	MT20	5.0	6.0		
S	BMWW-t	MT20	5.0	6.0		
T	BMWW-t	MT20	5.0	6.0		
U	BS-t	MT20	5.0	6.0		
V	BMWW-t	MT20	6.0	8.0	3.00	2.00
W	BMWW-t	MT20	5.0	6.0	2.50	2.50
X	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

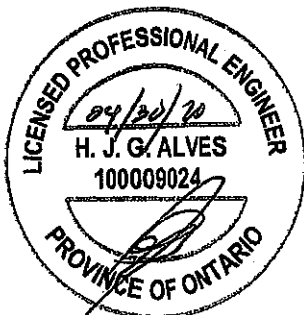


Structural component only
DWG# T-2008014

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	T11	1	3	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:46 2020 Page 1

ID:DMCubINVR6TstFos31v6I_zns11-5ZKIGIG8?Vlr7pZ1lsgPLbSCynXzvWesMyLacZLaex

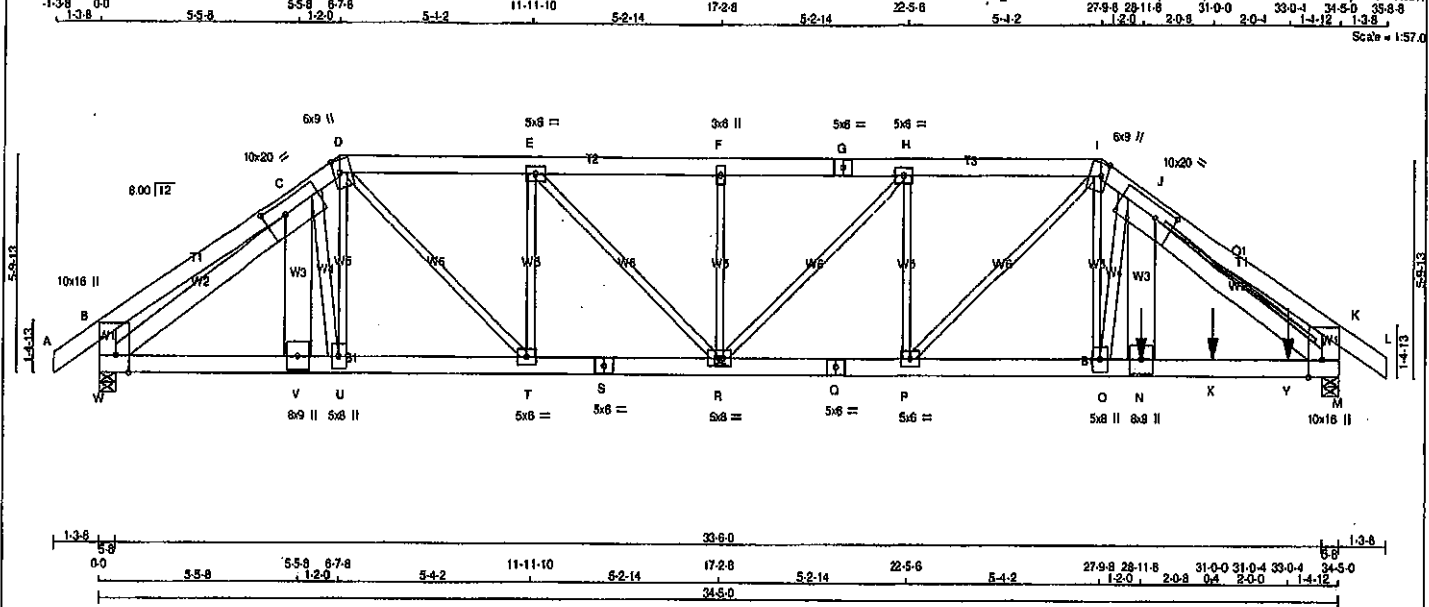

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x6 DRY	No.2	SPF		
D - G	2x6 DRY	No.2	SPF		
G - I	2x6 DRY	No.2	SPF		
I - L	2x6 DRY	No.2	SPF		
W - B	2x6 DRY	No.2	SPF		
M - K	2x6 DRY	No.2	SPF		
W - S	2x6 DRY	1650F 1.5E	SPF		
S - Q	2x6 DRY	1650F 1.5E	SPF		
Q - M	2x6 DRY	1650F 1.5E	SPF		

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT

V - C 2x10 DRY No.2 SPF

C - U 2x4 DRY No.2 SPF

W - C 2x6 DRY No.2 SPF

N - J 2x10 DRY No.2 SPF

O - J 2x4 DRY No.2 SPF

J - M 2x6 DRY No.2 SPF

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - D 2 12		TOP
D - G 2 12		TOP
G - I 2 12		TOP
I - L 2 12		TOP
W - B 2 12		TOP
M - K 2 12		TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
W - S 2 5		TOP
S - Q 2 12		TOP
Q - M 2 5		SIDE(824.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1 8		TOP
2x4 1 8		TOP
2x6 2 8		TOP
J - N 5 4		SIDE(2840.4)
2x10 5 4		SIDE(2840.4)

STAGGER NAILS BY HALF THE SURFACE SPACING IN ADJACENT PLIES.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	HORZ	DOWN	HORZ	UPLIFT
W 4072	0	4072	0	5-8
M 14508	0	14508	0	5-8

UNFACTORED REACTIONS	1ST LCASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
W 2875	1913	0	0/0
M 10243	8816	0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) W, M
BEARING SIZE FACTOR = 1.15 AT JNT(S) M (BASED ON SUPPORT DEPTH = 1-8)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.59 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x6 DRY SPF No.2 T-BRACE AT J-M

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MEMB.	FORCE (LBS)	FACTORED	VERT. LOAD (LBS)	MAX. FACTORED	CS1 (LC)	UNBRAC	MAX. FACTORED	CS1 (LC)
FR-TO									
A-B	0.36								
B-C	0.15								
C-D	-5481.0								
D-E	-7359.0								
E-F	-9818.0								
F-G	-9618.0								
G-H	-9818.0								
H-I	-11353.0								
I-J	-15043.0								
J-K	-114.0								
K-L	0.36								
W-B	-349.0								
M-K	-580.0								
W-V	0.4381								
V-U	0.4377								
U-T	0.4472								
T-S	0.7359								
S-R	0.7359								
R-Q	0.11353								
Q-P	0.11353								
P-O	0.12609								
O-N	0.15181								
N-X	0.14810								
X-Y	0.14810								
Y-M	0.14810								

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
N 28-11-8	-11612	-11612	---	---	---	FRONT	VERT	TOTAL	---	C1
X 31-0-4	-1456	-1456	---	---	---	FRONT	VERT	TOTAL	---	C1
Y 33-0-4	-1456	-1456	---	---	---	FRONT	VERT	TOTAL	---	C1

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

[55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD] EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.15')

CALCULATED VERT. DEFL.(LL) = L/999 (0.13')

ALLOWABLE DEFL.(TL) = L/360 (1.15')

CALCULATED VERT. DEFL.(TL) = L/999 (0.24')

CS1: TC=0.35/1.00 (I-J-I), BC=0.72/1.00 (M-N-I),

WB=0.87/1.00 (H-R-I), SS1=0.31/1.00 (M-N-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1687 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.86 (I) (INPUT = 0.90)

JSI METAL=0.92 (N) (INPUT = 1.00)



Structural component only

DWG# T-2008015

JOB NAME 408315	TRUSS NAME T11	QUANTITY 1	PLY 3	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Pool Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 09:31:46 2020 Page 2
ID:DMCubINVR6TslFoe31v6l_zns11-5ZKIGiQ67Vlr7pZ1eqPLbSCvnXzvWEsMyl.eczLa9x

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B, K, M, W						
B						
B	TMBMWV1*	pMT20	10.0	16.0	Edge	4.50
C	TMBWWV1	MT20	10.0	20.0	4.00	6.75
D	TTWW+m	MT20	6.0	9.0	4.00	2.00
E	TMBWW1	MT20	5.0	6.0		
F	TMBW+w	MT20	3.0	6.0		
G	TS-1	MT20	5.0	6.0		
H	TMBWW1	MT20	5.0	6.0		
I	TTWW+m	MT20	6.0	9.0	4.00	2.00
J	TMBWWV1	MT20	10.0	20.0	4.00	6.75
M	TMBMWV1*	pMT20	10.0	16.0	Edge	4.50
N	BMW+w	MT20	6.0	9.0		
O	BMWW+1	MT20	5.0	6.0		
P	BMWW+1	MT20	5.0	6.0		
Q	BS-1	MT20	5.0	6.0		
R	BMWWV1	MT20	5.0	6.0		
S	BS-1	MT20	5.0	6.0		
T	BMWW1	MT20	5.0	6.0		
U	BMWW+1	MT20	5.0	6.0		
V	BMW+w	MT20	6.0	9.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2008016

CONTINUED ON PAGE 2

JOB NAME 408315	TRUSS NAME T12	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 8 Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:48 2020 Page 2
ID:DMCubINVR6TstFoe31v6f zns11-1xSehORNX6vb4Jzx8qUmhliTiRoxXKqRSiVzLaev

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWV-p	MT20	8.0	12.0	1.50	Edge
B	TMWV-t	MT20	5.0	8.0		
C	TTWV+m	MT20	7.0	8.0		Edge
D	TMWV-w	MT20	3.0	6.0		
E	TTWV-t	MT20	7.0	8.0		Edge
F	TMWV-t	MT20	5.0	6.0		
G	TMWV-p	MT20	6.0	12.0	1.50	Edge
H	BMV1-t	MT20	5.0	8.0		Edge 0.50
I	BMWV-t	MT20	7.0	8.0	4.25	2.00
J	BMWV-t	MT20	5.0	8.0	4.25	2.50
K	BMWVW-t	MT20	5.0	8.0		
L	BS-t	MT20	5.0	6.0		
M	BMWV-t	MT20	5.0	8.0	4.25	2.50
N	BMWV-t	MT20	7.0	8.0	4.25	2.00
O	BMV1-t	MT20	5.0	8.0		5.50

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
T	9-8-4	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
U	11-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
V	13-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
W	15-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
X	17-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
Y	19-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
Z	21-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
AA	23-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1
AB	25-0-12	-1571	-1571	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS


- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2008017 72

JOB NAME 408315	TRUSS NAME T13	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 6.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 09:31:49 2020 Page 1
ID:DMCubINVR6TstFos31v6l_zns11-V800vKS?IQ1SITYI0BX1_Dry6wsAOtgYKA?FzLaeu

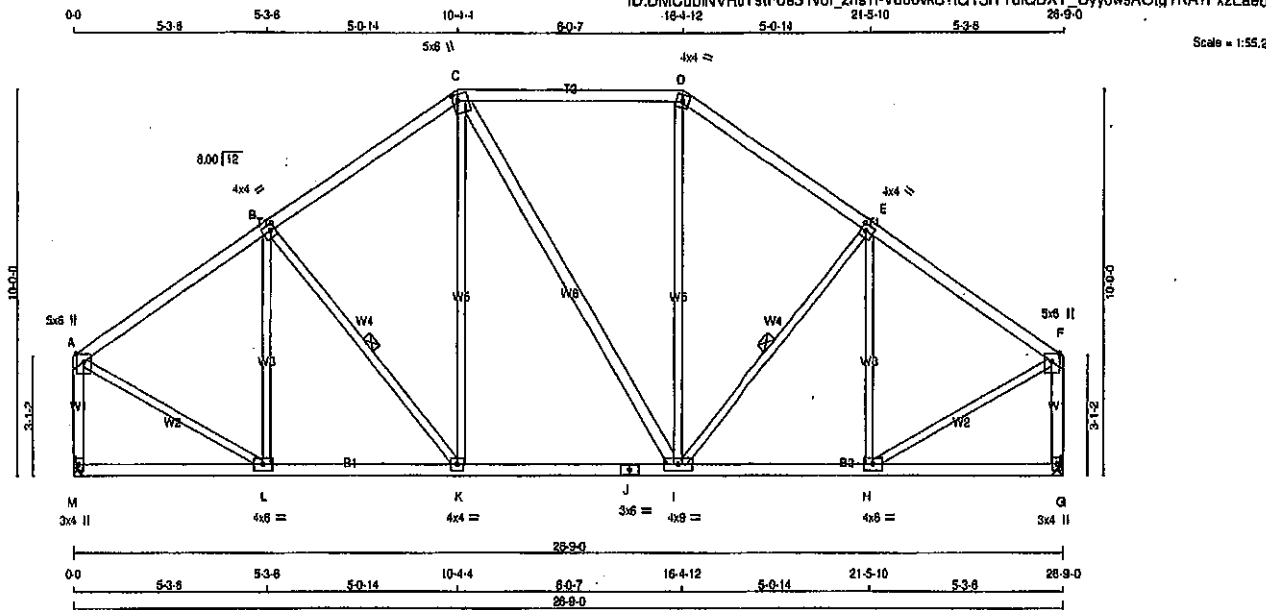

TOTAL WEIGHT = 132 lb

LUMBER			
N.L.G.A. RULES	CHORDS	SIZE	LUMBER
A - G	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
M - A	2x4	DRY	No.2
G - F	2x4	DRY	No.2
M - J	2x4	DRY	No.2
J - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
C - I	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWW+p	MT20	5.0	6.0	Edge	
B	TMWW-t	MT20	4.0	4.0	2.00	1.50
C	TTWW+m	MT20	5.0	6.0	2.00	1.50
D	TTWW-m	MT20	4.0	4.0		
E	TMWW-t	MT20	4.0	4.0	2.00	1.50
F	TMWW+p	MT20	5.0	6.0	Edge	
G	BMV1+p	MT20	3.0	4.0		
H	BMWW-t	MT20	4.0	6.0		
I	BMWWW-t	MT20	4.0	9.0		
J	BS-t	MT20	3.0	6.0		
K	BMWW-t	MT20	4.0	4.0		
L	BMWW-t	MT20	4.0	6.0		
M	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	HORIZ	DOWN	HORIZ
M	1475	0	1475	0
G	1475	0	1475	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT M, G. MINIMUM BEARING LENGTH AT JOINT M = 3-8, JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	1043	884 / 0	0 / 0	0 / 0	0 / 0	358 / 0	0 / 0
G	1043	884 / 0	0 / 0	0 / 0	0 / 0	358 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.39 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF B-K, E-I.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	-1227 / 0	-91.8 -91.8	0.34 (1)	5.39	L-B	-445 / 0	0.32 (1)
B-C	-1198 / 0	-91.8 -91.8	0.34 (1)	5.44	B-K	-124 / 0	0.06 (1)
C-D	-971 / 0	-91.8 -91.8	0.44 (1)	5.70	K-C	0 / 197	0.05 (4)
D-E	-1199 / 0	-91.8 -91.8	0.34 (1)	5.44	C-I	0 / 0	0.00 (1)
E-F	-1227 / 0	-91.8 -91.8	0.34 (1)	5.39	I-D	0 / 198	0.05 (4)
M-A	-1434 / 0	0.0 0.0	0.24 (1)	6.82	I-E	-124 / 0	0.06 (1)
G-F	-1434 / 0	0.0 0.0	0.24 (1)	6.82	H-E	-445 / 0	0.32 (1)
					A-L	0 / 1183	0.27 (1)
					H-F	0 / 1183	0.27 (1)
M-L	0 / 0	-18.5 -18.5	0.12 (4)	10.00			
L-K	0 / 1047	-18.5 -18.5	0.23 (1)	10.00			
K-J	0 / 971	-18.5 -18.5	0.22 (1)	10.00			
J-I	0 / 971	-18.5 -18.5	0.22 (1)	10.00			
I-H	0 / 1047	-18.5 -18.5	0.23 (1)	10.00			
H-G	0 / 0	-18.5 -18.5	0.11 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.89")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.04")
ALLOWABLE DEFL.(TL) = $L/360$ (0.89")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.08")

CSI: TC=0.44/1.00 (C-D:1), BC=0.23/1.00 (H-I:1), WB=0.32/1.00 (E-H:1), SSI=0.22/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	618	354	1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.69 (A) (INPUT = 0.90)
JSI METAL = 0.50 (A) (INPUT = 1.00)



Structural component only
DWG# T-2008018

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	T14S	1	1	GREEN PARK HOMES	
amarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 09:31:50 2020 Page 1
ID:DMCubINVR6TsIFoe31v6l_zns1l-zKa0B4Td3J9Kc7KG8maBm8aWfVsdqn_wZnNzLaet

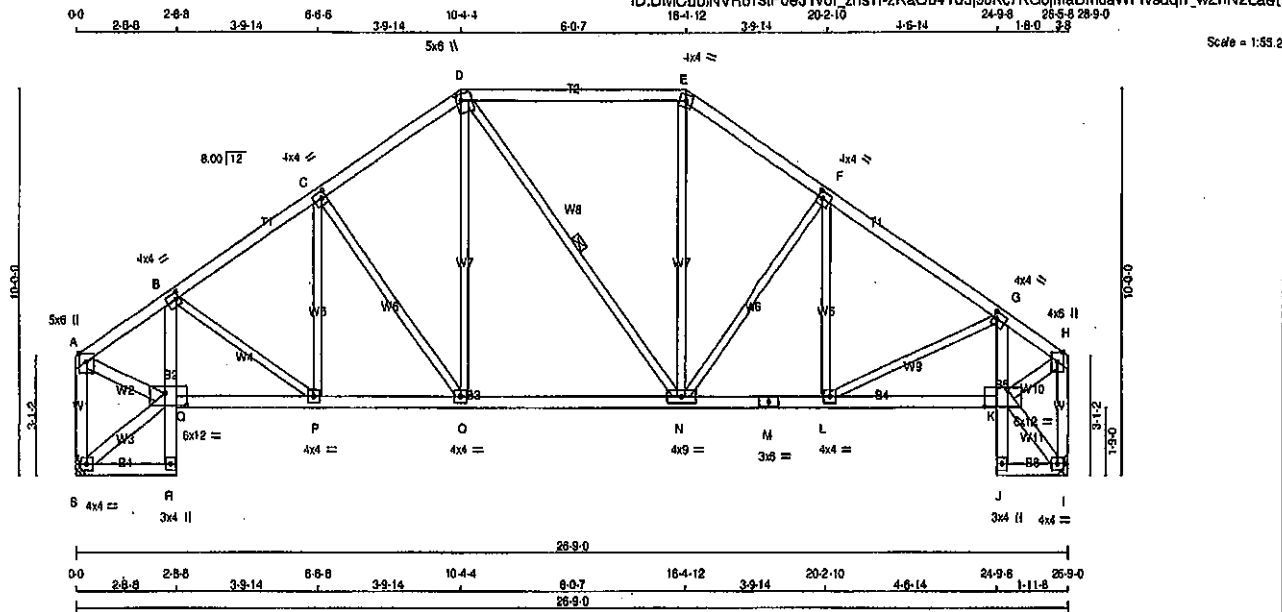

TOTAL WEIGHT = 138 lb (M/F)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - O	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - H	2x4	DRY	No.2	SPF	
S - A	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
S - R	2x4	DRY	No.2	SPF	
R - B	2x4	DRY	No.2	SPF	
Q - M	2x4	DRY	No.2	SPF	
M - K	2x4	DRY	No.2	SPF	
J - G	2x4	DRY	No.2	SPF	
J - I	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
S - Q	2x4	DRY	No.2	SPF	
A - O	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
K - H	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	5.0	6.0	Edge	
B	TMVW-i	MT20	4.0	4.0	2.00	1.00
C	TMVW-i	MT20	4.0	4.0	2.00	1.50
D	TTWW+m	MT20	5.0	6.0	2.00	1.50
E	TTW-m	MT20	4.0	4.0		
F	TMVW-i	MT20	4.0	4.0	2.00	1.50
G	TMVW-i	MT20	4.0	4.0	2.00	1.00
H	TMVW-p	MT20	4.0	6.0	Edge	
I	BMVW-i	MT20	4.0	4.0		
J	BMV-p	MT20	3.0	4.0		
K	BMVW-i	MT20	6.0	12.0	5.25	7.25
L	O.P.					
M	BMVW-i	MT20	4.0	4.0		
N	BS-i	MT20	3.0	6.0		
O	BMVW-i	MT20	4.0	9.0		
Q	BMVW-i	MT20	6.0	12.0	3.75	7.00
R	BMV-p	MT20	3.0	4.0		
S	BMVW-i	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	REQD
				BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
S	1475	0	1475	0	0
I	1475	0	1475	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT S, I. MINIMUM BEARING LENGTH AT JOINT S = 3-8, JOINT I = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
S	1043	684 / 0	0 / 0	0 / 0	0 / 0	358 / 0	0 / 0	
I	1043	684 / 0	0 / 0	0 / 0	0 / 0	358 / 0	0 / 0	

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.94 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FORCE	VERT. LOAD	MEMB.	MAX. FACTORED	FORCE	MAX
		(LBS)	CS1 (LC)			(LBS)	CS1 (LC)
FR-TO				FR-TO			
A-B	-1511 / 0	-91.8	-91.8 0.11 (1)	5.25	B-P	0 / 124	0.03 (1)
B-C	-1853 / 0	-91.8	-91.8 0.19 (1)	4.99	P-C	0 / 65	0.02 (4)
C-D	-1440 / 0	-91.8	-91.8 0.18 (1)	5.28	C-O	-345 / 0	0.28 (1)
D-E	-1184 / 0	-91.8	-91.8 0.45 (1)	5.28	O-D	0 / 375	0.08 (1)
E-F	-1445 / 0	-91.8	-91.8 0.21 (1)	5.23	D-N	0 / 0	0.00 (1)
F-G	-1884 / 0	-91.8	-91.8 0.22 (1)	4.84	N-E	0 / 383	0.09 (1)
G-H	-1355 / 0	-91.8	-91.8 0.14 (1)	5.43	N-F	-357 / 0	0.28 (1)
S-A	-1442 / 0	0.0	0.0 0.24 (1)	6.81	L-F	-24 / 54	0.02 (4)
I-H	-1444 / 0	0.0	0.0 0.24 (1)	6.80	L-G	0 / 244	0.05 (1)
					S-Q	-16 / 0	0.00 (1)
S-R	0 / 13	-18.5	-18.5 0.04 (4)	10.00	A-Q	0 / 1370	0.22 (1)
R-Q	0 / 27	0.0	0.0 0.03 (1)	10.00	K-I	-20 / 0	0.00 (1)
Q-B	-460 / 0	0.0	0.0 0.03 (1)	7.81	K-H	0 / 1330	0.21 (1)
Q-P	0 / 1280	-18.5	-18.5 0.25 (1)	10.00			
P-O	0 / 1383	-18.5	-18.5 0.28 (1)	10.00			
O-N	0 / 1184	-18.5	-18.5 0.25 (1)	10.00			
N-M	0 / 1390	-18.5	-18.5 0.28 (1)	10.00			
M-L	0 / 1380	-18.5	-18.5 0.28 (1)	10.00			
L-K	0 / 1169	-18.5	-18.5 0.24 (1)	10.00			
J-K	0 / 19	0.0	0.0 0.04 (1)	10.00			
K-G	-613 / 0	0.0	0.0 0.03 (1)	7.81			
J-I	0 / 15	-18.5	-18.5 0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/860 (0.88")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/860 (0.88")
CALCULATED VERT. DEFL.(TL) = L/999 (0.10")

CS1: TC=0.45/1.00 (D-E:1), RC=0.28/1.00 (L-N:1), WB=0.29/1.00 (F-N:1), SS=0.22/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1687


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (3) (INPUT = 0.90)
JSI METAL= 0.64 (4) (INPUT = 1.00)

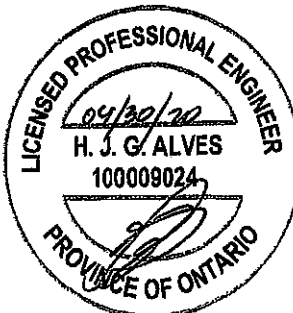

Structural component only
DWG# T-2008019

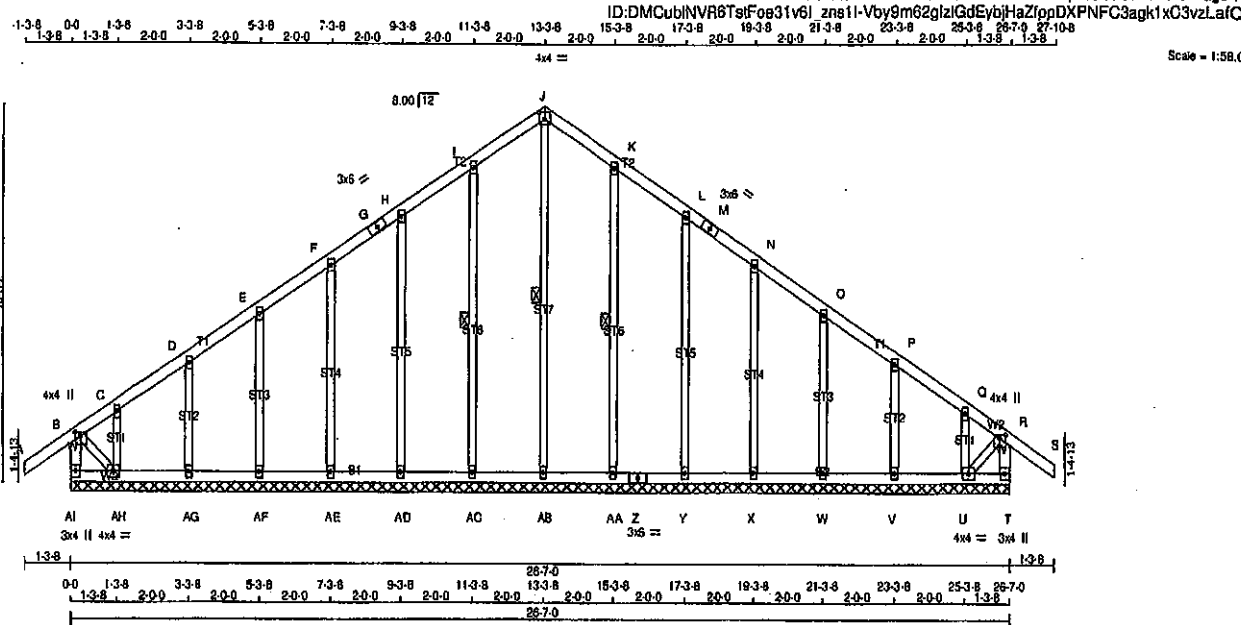

Scale = 1/8" = 1'-0"

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - G	2x4	DRY No.2	SPF
G - J	2x4	DRY No.2	SPF
J - M	2x4	DRY No.2	SPF
M - S	2x4	DRY No.2	SPF
AI - B	2x4	DRY No.2	SPF
T - R	2x4	DRY No.2	SPF
AI - Z	2x4	DRY No.2	SPF
Z - T	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

ALL GABLE WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.25	2.00
C, D, E, F, H, I, K, L, N, O, P, Q	MT20	2.0	4.0		
G TS-I	MT20	3.0	6.0		
J TTW+p	MT20	4.0	4.0	2.25	2.00
M TS-I	MT20	3.0	6.0		
R TMVW+p	MT20	4.0	4.0	1.25	2.00
T BMV1+p	MT20	3.0	4.0		
U BMWV1-I	MT20	4.0	4.0		
V, W, X, Y, AA, AB, AC, AD, AE, AF, AG	MT20	2.0	4.0		
Z BS-I	MT20	3.0	6.0		
AI BMWV1-I	MT20	4.0	4.0		
AI BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF J-AB, I-AC, K-AA.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LO)	MEMB.	MAX. FORCE (LBS)	MAX. CSI (LO)	
FR-TO				FR-TO			
A-B	0/35	-91.8	-91.8 0.12 (1)	10.00	AB-J	-139/0	0.10 (1)
B-C	-70/0	-91.8	-91.8 0.12 (1)	6.25	AC-I	-208/0	0.11 (1)
C-D	-24/0	-91.8	-91.8 0.05 (1)	6.25	AD-H	-177/0	0.19 (1)
D-E	-27/0	-91.8	-91.8 0.05 (1)	6.25	AE-F	-183/0	0.11 (1)
E-F	-21/0	-91.8	-91.8 0.04 (1)	6.25	AF-E	-178/0	0.06 (1)
F-G	-19/0	-91.8	-91.8 0.04 (1)	6.25	AG-D	-195/0	0.04 (1)
G-H	-19/0	-91.8	-91.8 0.04 (1)	6.25	AH-C	-70/0	0.01 (1)
H-I	-14/0	-91.8	-91.8 0.05 (1)	6.25	AA-K	-208/0	0.11 (1)
I-J	-24/0	-91.8	-91.8 0.05 (1)	6.25	Y-L	-177/0	0.19 (1)
J-K	-24/0	-91.8	-91.8 0.05 (1)	6.25	X-N	-183/0	0.11 (1)
K-L	-14/0	-91.8	-91.8 0.05 (1)	6.25	W-O	-178/0	0.06 (1)
L-M	-19/0	-91.8	-91.8 0.04 (1)	6.25	V-P	-195/0	0.04 (1)
M-N	-19/0	-91.8	-91.8 0.04 (1)	6.25	U-Q	-70/0	0.01 (1)
N-O	-21/0	-91.8	-91.8 0.04 (1)	6.25	BAH	0/38	0.01 (1)
O-P	-27/0	-91.8	-91.8 0.05 (1)	6.25	U-R	0/38	0.01 (1)
P-Q	-24/0	-91.8	-91.8 0.05 (1)	6.25			
Q-R	-70/0	-91.8	-91.8 0.12 (1)	6.25			
R-S	0/35	-91.8	-91.8 0.12 (1)	10.00			
AI-B	-288/0	0.0	0.0 0.03 (1)	7.81			
T-R	-288/0	0.0	0.0 0.03 (1)	7.81			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BOBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (AG-AH:4), WB=0.19/1.00 (I-Y:1), SS=0.08/1.00 (A-B:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION

(PS)	(PL)	(PL)
MT20	618	354 1887 788 1887 1856

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.49 (U) (INPUT = 0.90)

JSI METAL = 0.11 (K) (INPUT = 1.00)




Structural component only
DWG# T-2007993

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ORWG NO.
408315	T16	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2018 MITek Industries, Inc. Thu Apr 30 09:31:52 2020 Page 1

ID:DMCubINVR6TstFoe31vdl_zns1l-wj9XIUIbLQ0ZwHjNYIE/crX1JyQNN77FIPsGzLae

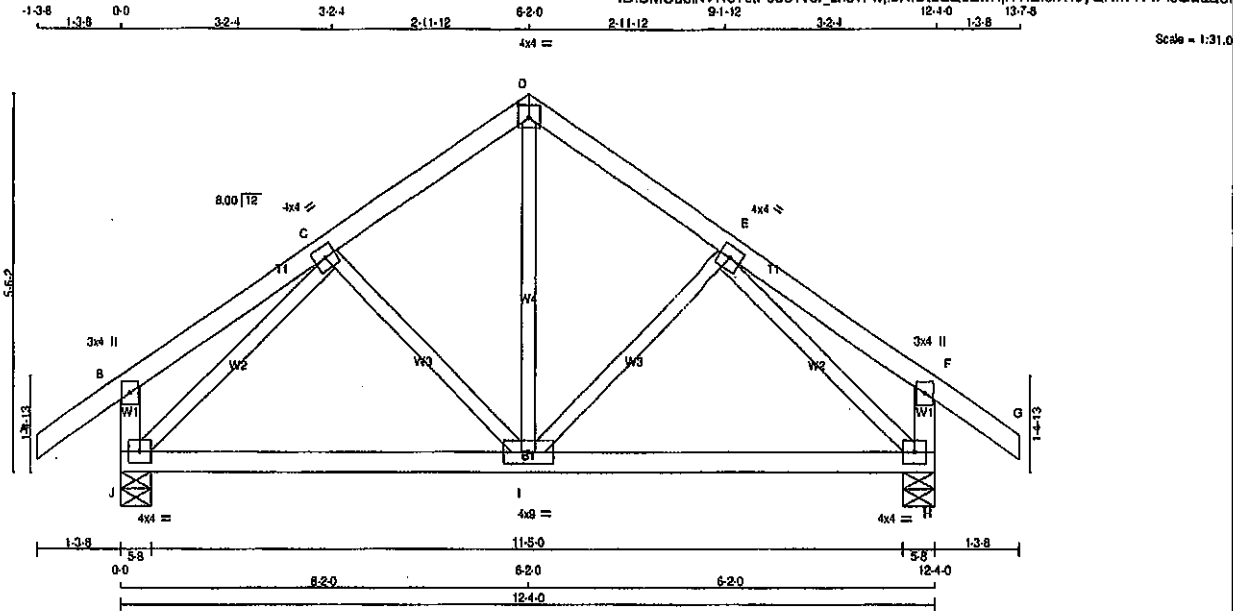

TOTAL WEIGHT = 54 lb (M/F)

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table in inches)			
JT TYPE	PLATES	W	LEN Y X
B TMV+p	MT20	3.0	4.0
C TMWW-1	MT20	4.0	4.0
D TTW-p	MT20	4.0	4.0
E TMWW-1	MT20	4.0	4.0
F TMV+p	MT20	3.0	4.0
H BMVW1-1	MT20	4.0	4.0
I BMVW1-1	MT20	4.0	9.0
J BMVW1-1	MT20	4.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG	BRG
J	806	0	806	0	0	5.8	5.8		
H	806	0	806	0	0	5.8	5.8		

UNFACTORED REACTIONS		IST LOASE		MAX/MIN. COMPONENT REACTIONS		LIVE		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW	SNOW
J	588	386/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	182.0	0/0	0/0	0/0
H	588	386/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	0/0	182.0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		MEMB.		MAX. FACTORED		FACTORED		W E B S		MEMB.		MAX. FACTORED		FACTORED	
FR-TO	FROM	TO	TO	TO	TO	TO	TO	FR-TO	FROM	TO	TO	TO	TO	TO	TO
A-B	0/35	-91.8	-91.8	0.12 (1)	10.00	10.00	10.00	I-D	0/337	0.08 (1)	0.08 (1)	0.08 (1)	0.08 (1)	0.08 (1)	0.08 (1)
B-C	0/17	-91.8	-91.8	0.13 (1)	10.00	10.00	10.00	I-E	-139/0	0.04 (1)	0.04 (1)	0.04 (1)	0.04 (1)	0.04 (1)	0.04 (1)
C-D	-521/0	-91.8	-91.8	0.10 (1)	8.25	8.25	8.25	C-I	-139/0	0.04 (1)	0.04 (1)	0.04 (1)	0.04 (1)	0.04 (1)	0.04 (1)
D-E	-521/0	-91.8	-91.8	0.10 (1)	8.25	8.25	8.25	J-C	-737/0	0.23 (1)	0.23 (1)	0.23 (1)	0.23 (1)	0.23 (1)	0.23 (1)
E-F	0/17	-91.8	-91.8	0.13 (1)	10.00	10.00	10.00	E-H	-737/0	0.23 (1)	0.23 (1)	0.23 (1)	0.23 (1)	0.23 (1)	0.23 (1)
F-G	0/35	-91.8	-91.8	0.12 (1)	10.00	10.00	10.00								
J-B	-238/0	0.0	0.0	0.02 (1)	7.81	7.81	7.81								
H-F	-238/0	0.0	0.0	0.02 (1)	7.81	7.81	7.81								
J-I	0/517	-18.5	-18.5	0.24 (4)	10.00	10.00	10.00								
I-H	0/517	-18.5	-18.5	0.24 (4)	10.00	10.00	10.00								

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/380$ (0.41")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.41")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.04")

CSI: TC=0.13/1.00 (B-C:1), BC=0.24/1.00 (H-I:4), WB=0.23/1.00 (C-J:1), SSI=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1650

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.68 (E) (INPUT = 0.90)
JSI METAL = 0.28 (E) (INPUT = 1.00)




Structural component only
DWG# T-2008020

JOB NAME 408315	TRUSS NAME G16	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Thu Apr 30 09:31:16 2020 Page 1
ID:DMCubiNVR6TstFoe31v6l_zns1l-znWXzR3I3H7EOXoG75oB0MOHplPxYpqzhgIbLzLaF

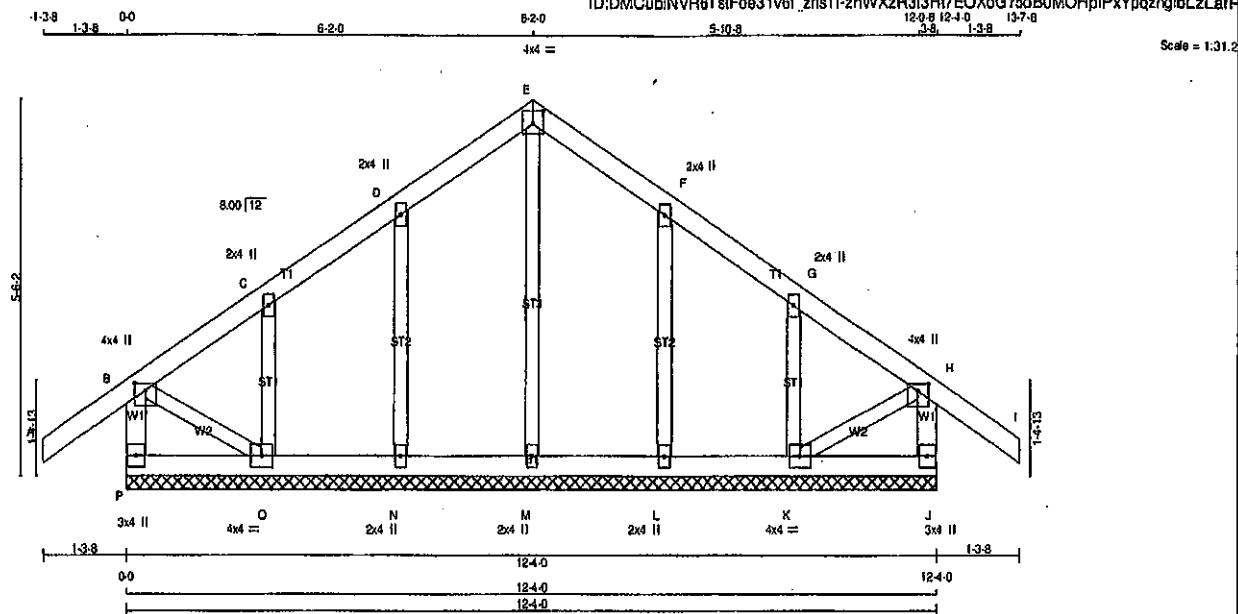

TOTAL WEIGHT = 54 lb

LUMBER			
N. L. G. A. RULES	SIZE	DRY	No.2
CHORDS	2x4	DRY	No.2
P - B	2x4	DRY	No.2
A - E	2x4	DRY	No.2
E - I	2x4	DRY	No.2
J - H	2x4	DRY	No.2
P - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMW+p	MT20	4.0	4.0	1.25	2.00
P, C, F, G					
C TMW+w	MT20	2.0	4.0		
E TTW+p	MT20	4.0	4.0	1.25	2.00
H TMW+p	MT20	3.0	4.0		
J BMW1+p	MT20	3.0	4.0		
K BMW1+1	MT20	4.0	4.0		
L, M, N					
I BMW1+w	MT20	2.0	4.0		
O BMW1+1	MT20	4.0	4.0		
P BMW1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (LBS)	MAX. FACTORED (PLF)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED (LC)	MAX. FACTORED (LC)
FR-TO				FR-TO			
P-B	-232 / 0	0.0	0.0 0.02 (1)	M-E	-137 / 0	0.08 (1)	0.08 (1)
A-B	0 / 35	-91.8	-91.8 0.12 (1)	N-D	-202 / 0	0.05 (1)	0.05 (1)
B-C	-19 / 0	-91.8	-91.8 0.05 (1)	O-C	-202 / 0	0.03 (1)	0.03 (1)
C-D	-22 / 0	-91.8	-91.8 0.05 (1)	L-F	-202 / 0	0.05 (1)	0.05 (1)
D-E	-27 / 0	-91.8	-91.8 0.05 (1)	K-G	-202 / 0	0.03 (1)	0.03 (1)
E-F	-27 / 0	-91.8	-91.8 0.05 (1)	B-O	0 / 28	0.01 (1)	0.01 (1)
F-G	-22 / 0	-91.8	-91.8 0.05 (1)	K-H	0 / 28	0.01 (1)	0.01 (1)
G-H	-19 / 0	-91.8	-91.8 0.05 (1)				
H-I	0 / 35	-91.8	-91.8 0.12 (1)				
J-H	-232 / 0	0.0	0.0 0.02 (1)				
P-O	0 / 0	-18.5	-18.5 0.02 (4)				
O-N	0 / 18	-18.5	-18.5 0.02 (4)				
N-M	0 / 14	-18.5	-18.5 0.02 (4)				
M-L	0 / 14	-18.5	-18.5 0.02 (4)				
L-K	0 / 18	-18.5	-18.5 0.02 (4)				
K-J	0 / 0	-18.5	-18.5 0.02 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR

SMALL BUILDING REQUIREMENTS OF PART 9,

NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019

- PART 9 OF OBC 2012 (2019 AMENDMENT)

- CSA 088-09, CSA 088-14

- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (H-H), BC=0.02/1.00 (K-L), WB=0.08/1.00 (E-M), SSI=0.08/1.00 (H-L)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 818 354 1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.90)

JSI METAL= 0.10 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007994

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	T17	2	1	GREEN PARK HOMES	
TRUSS DESC.					

Amareck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 09:31:53 2020 Page 1
ID:DMCubINVR6TsIFoe31v6f_2ns11-OvFXK5VVMeytB4svxGOTBQeNjHr643GTy8DOizLaec

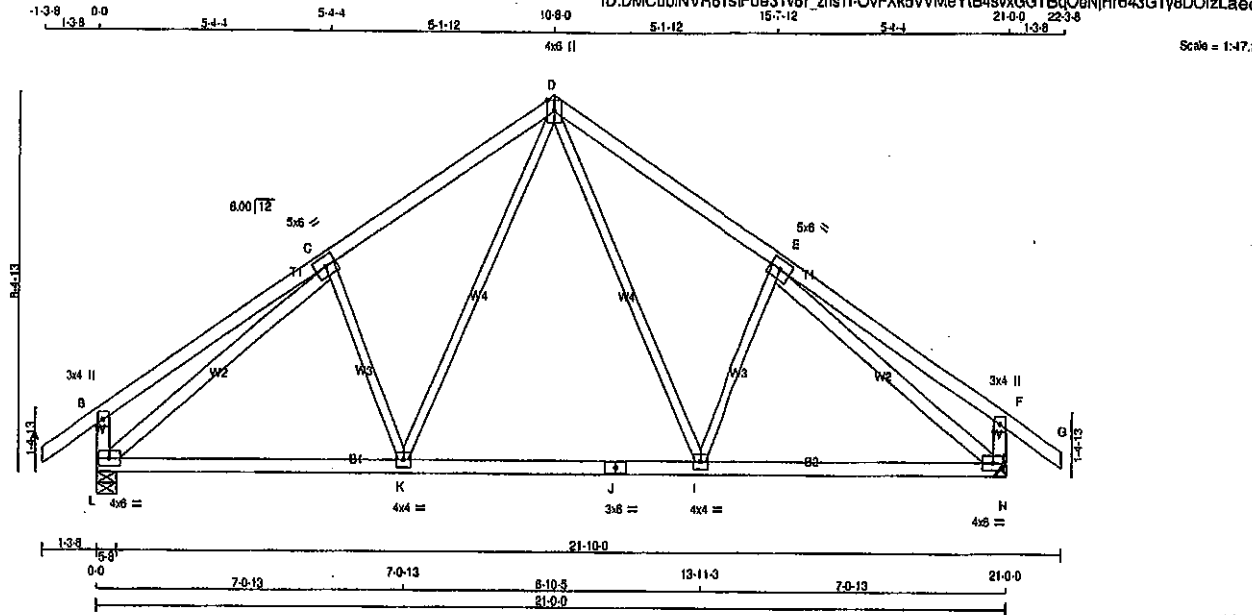

Scale = 1:47.2

TOTAL WEIGHT = 2 X 95 = 191 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DRY
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
L - C	2x4	DRY	No.2
E - H	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	5.0	8.0		
D	TTWW+p	MT20	4.0	8.0	Edge	
E	TMWW-t	MT20	5.0	8.0		
F	TMV+p	MT20	3.0	4.0		
H	BMVW1-t	MT20	4.0	6.0		
I	BMWW-t	MT20	4.0	4.0		
J	BS-t	MT20	3.0	8.0		
K	BMVW1-t	MT20	4.0	4.0		
L	BMVW1-t	MT20	4.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
L	1284	0	1284	0	5-8
H	1284	0	1284	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	805	608 / 0	0 / 0	0 / 0	0 / 0	0 / 0	288 / 0	0 / 0
H	805	608 / 0	0 / 0	0 / 0	0 / 0	0 / 0	288 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.52 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0 / 35	D-I	0 / 475
B-C	0 / 32	I-E	-321 / 0
C-D	-1155 / 0	K-D	0 / 475
D-E	-1155 / 0	C-K	-321 / 0
E-F	0 / 32	L-C	-1403 / 0
F-G	0 / 35	E-H	-1403 / 0
L-B	-307 / 0		
H-F	-307 / 0		
L-K	0 / 1056		
K-J	0 / 749		
J-I	0 / 749		
I-H	0 / 1056		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6 PSF
BOT CH.	LL	= 6.0 PSF
	DL	= 0.0 PSF
	DL	= 7.4 PSF
TOTAL LOAD		= 39.0 PSF

SPACING = 24.0 IN. G.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $\frac{1}{360}$ (0.70")
CALCULATED VERT. DEFL.(LL) = $\frac{1}{999}$ (0.04")
ALLOWABLE DEFL.(TL) = $\frac{1}{360}$ (0.70")
CALCULATED VERT. DEFL.(TL) = $\frac{1}{999}$ (0.09")

CS: TO=0.42/1.00 (B-C:1), BC=0.29/1.00 (K-L:4),
WB=0.89/1.00 (C-L:1), SSI=0.19/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(FSH) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.70 (E) (INPUT = 0.90)
JSI METAL= 0.36 (E) (INPUT = 1.00)



Structural component only
DWG# T-2008021

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	ORWGNO.
408315	G17	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:17 2020 Page 1
ID:DMCubINVR6TstFoe3tv6l_zns1l-R_4wBn3wqb7_sY5_qid1kEuZ1D2Yqz7zCLQJ7ozLafo
20-8-8 21-0-0 22-3-8
3-8 1-3-8

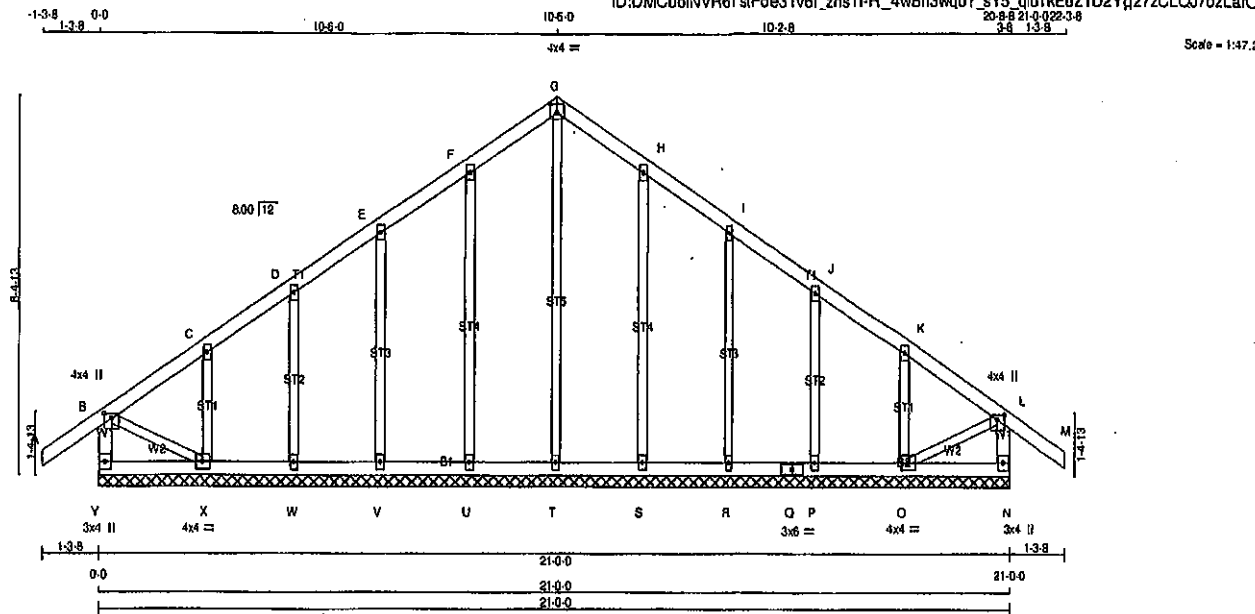

TOTAL WEIGHT = 68 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DESCR.
Y - B	2x4	DRY	No.2
A - G	2x4	DRY	No.2
G - M	2x4	DRY	No.2
N - L	2x4	DRY	No.2
Y - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			
GABLE STUDS SPACED AT 2'-0" OC.			

PLATES (table in inches)			
JT TYPE	PLATES	W	LEN Y X
B TMVW+p	MT20	4.0	4.0 1.25 2.00
C, D, E, F, H, J, K			
G TMVW+p	MT20	2.0	4.0
H TTW+p	MT20	4.0	4.0 2.25 2.00
L TMVW+p	MT20	4.0	4.0 1.25 2.00
N BMVW+p	MT20	3.0	4.0
O BMVW+p	MT20	4.0	4.0
P, R, S, T, U, V, W			
Q BMVW+p	MT20	2.0	4.0
Q BS-L	MT20	3.0	6.0
X BMVW+p	MT20	4.0	4.0
Y BMVW+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER
BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
Y-B	-250/0	0.0	0.0 0.03 (1)	T-G	-133/0	0.18 (1)	
A-B	0/35	-91.8	-91.8 0.12 (1)	U-F	-208/0	0.18 (1)	
B-C	-26/0	-91.8	-91.8 0.07 (1)	V-E	-180/0	0.09 (1)	
C-D	-36/0	-91.8	-91.8 0.07 (1)	W-D	-187/0	0.05 (1)	
D-E	-24/0	-91.8	-91.8 0.04 (1)	X-C	-231/0	0.04 (1)	
E-F	-20/0	-91.8	-91.8 0.05 (1)	S-H	-208/0	0.18 (1)	
F-G	-29/0	-91.8	-91.8 0.05 (1)	R-I	-180/0	0.09 (1)	
G-H	-29/0	-91.8	-91.8 0.05 (1)	P-J	-187/0	0.05 (1)	
H-I	-20/0	-91.8	-91.8 0.05 (1)	Q-K	-231/0	0.04 (1)	
I-J	-24/0	-91.8	-91.8 0.04 (1)	B-X	0/34	0.01 (1)	
J-K	-36/0	-91.8	-91.8 0.07 (1)	O-L	0/34	0.01 (1)	
K-L	-26/0	-91.8	-91.8 0.07 (1)				
L-M	0/35	-91.8	-91.8 0.12 (1)				
N-L	-250/0	0.0	0.0 0.03 (1)				
Y-X	0/0	-18.5	-18.5 0.03 (4)				
X-W	0/24	-18.5	-18.5 0.03 (4)				
W-V	0/21	-18.5	-18.5 0.02 (4)				
V-U	0/18	-18.5	-18.5 0.02 (4)				
U-T	0/18	-18.5	-18.5 0.02 (4)				
T-S	0/18	-18.5	-18.5 0.02 (4)				
S-R	0/18	-18.5	-18.5 0.02 (4)				
R-Q	0/21	-18.5	-18.5 0.02 (4)				
Q-P	0/21	-18.5	-18.5 0.02 (4)				
P-O	0/24	-18.5	-18.5 0.03 (4)				
O-N	0/0	-18.5	-18.5 0.03 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (L-M:1), SC=0.03/1.00 (W-X:4), WB=0.18/1.00 (G-T:1), SS=0.09/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(P.S.) (P.L.) (P.L.)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1887 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.59 (X) (INPUT = 0.90)
JSI METAL= 0.12 (K) (INPUT = 1.00)



Structural component only
DWG# T-2007995


Structural component only
DWG# T-2007996

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T18S	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:05:21 2020 Page 1

ID:DMCubINVR6TstF0e31v6l_zns1l-bDbdAio2TcXz4fMqZ_lMaGYr69dWbOmQDMZUwzLa9S

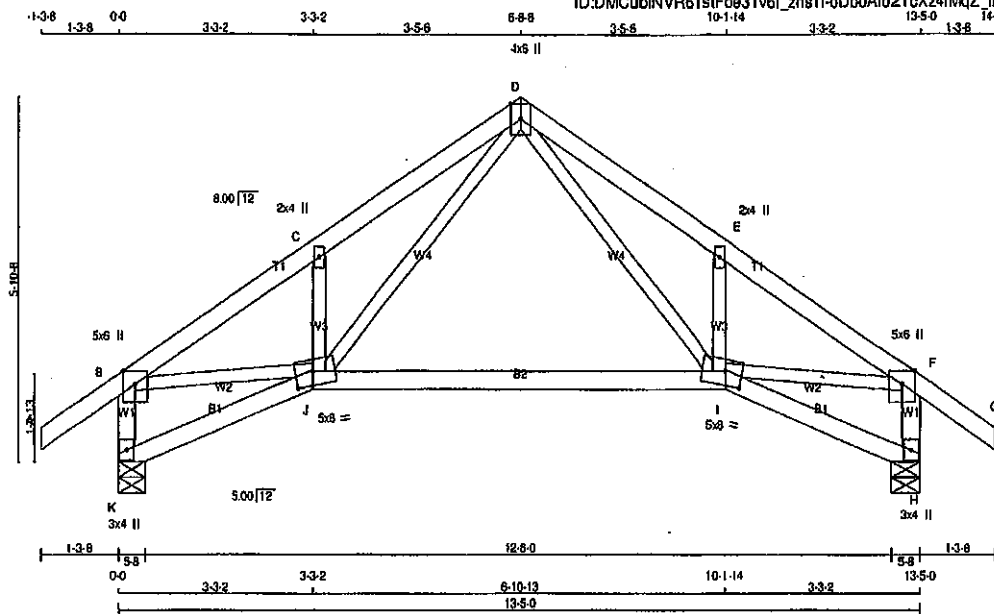

Scale = 1/32

TOTAL WEIGHT = 2 X 57 = 115 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
K - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
K - J	2x4	DRY	No.2
J - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMVW+p	MT20	5.0	6.0	Edge
C TMVW+w	MT20	2.0	4.0	
D TTWV+p	MT20	4.0	6.0	Edge
E TMVW+w	MT20	2.0	4.0	
F TMVW+p	MT20	5.0	6.0	Edge
H BMV1+p	MT20	3.0	4.0	
I BBWWV-m	MT20	5.0	8.0	2.75 3.50
J BBWWV-m	MT20	5.0	8.0	2.75 3.50
K BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	UP	BRG	UP
K	888	0	888	0	0	5-8	5-8	5-8	5-8
H	888	0	888	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX	MIN	COMPONENT REACTIONS	WIND	DEAD	SOIL
K	610	413/0	0/0	0/0	0/0	198/0	0/0
H	610	413/0	0/0	0/0	0/0	198/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.84 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	VERT. LOAD (PL)	MAX. FACTORED	MEMB.	FORCE (LBS)	VERT. LOAD (PL)	MAX. FACTORED
FR-TO				FR-TO			
A-B	0/35	-91.8	-91.8 0.12 (1)	D-I	0/623	0.14 (1)	
B-C	-1092/0	-91.8	-91.8 0.12 (1)	E-J	-389/0	0.08 (1)	
C-D	-1130/0	-91.8	-91.8 0.13 (1)	J-K	0/623	0.14 (1)	
D-E	-1130/0	-91.8	-91.8 0.13 (1)	K-L	-389/0	0.08 (1)	
E-F	-1092/0	-91.8	-91.8 0.12 (1)	L-M	0/623	0.21 (1)	
F-G	0/35	-91.8	-91.8 0.12 (1)	M-N	0/623	0.21 (1)	
G-H	-835/0	0.0	0.0 0.09 (1)				
H-I	-835/0	0.0	0.0 0.09 (1)				
K-J	0/0	-18.5	-18.5 0.06 (4)				
J-I	0/541	-18.5	-18.5 0.30 (4)				
I-H	0/0	-18.5	-18.5 0.06 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.45")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.03")
ALLOWABLE DEFL.(TL) = $L/360$ (0.45")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.15")

CSI: TC=0.13/1.00 (C-D:1), BC=0.30/1.00 (I-J:4), WB=0.21/1.00 (F-I:1), SS=0.12/1.00 (G-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1887 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.78 (F) (INPUT = 0.90)
JSI METAL = 0.46 (F) (INPUT = 1.00)




Structural component only
DWG# T-2008027

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	T19	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 09:31:58 2020 Page 1

ID:DMCubINVR6TstFoe31v6I_zns1I-oUxIN7YOeZwS2XaUcOpApS0BfxHDJWdIAwNk?1zLaen

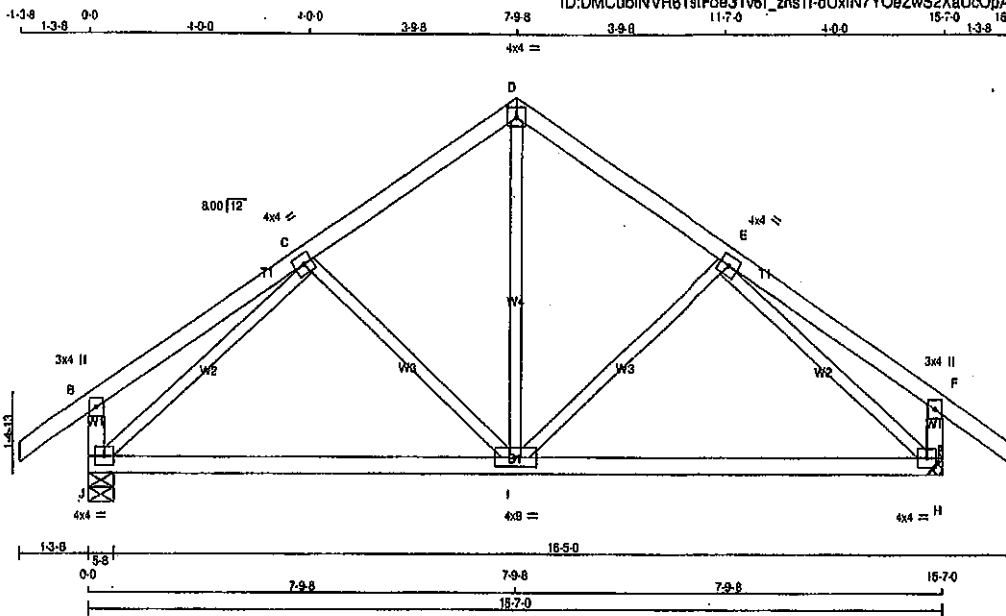

TOTAL WEIGHT = 3 X 66 = 199 lb
(M/F)

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
J	985	0	985	0	0
H	985	0	985	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3.8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	894	489/0	0/0	0/0	0/0	225/0	0/0	0/0
H	894	489/0	0/0	0/0	0/0	225/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	0/35	I-D	0/483
B-C	0/23	I-E	-208/0
C-D	-889/0	C-I	-208/0
D-E	-889/0	J-C	-971/0
E-F	0/23	E-H	-971/0
F-G	0/35		
G-H	-263/0		
H-F	-263/0		
J-I	0/706		
I-H	0/706		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/380$ (0.52")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.02")
ALLOWABLE DEFL. (TL) = $L/360$ (0.52")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.09")

CSI: TC=0.22/1.00 (B-C:1), BC=0.38/1.00 (I-J:4),
WB=0.45/1.00 (C-J:1), SS=0.14/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 789 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.82 (J) (INPUT = 0.90)
JSI METAL = 0.34 (E) (INPUT = 1.00)




Structural component only
DWG# T-2008023

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408315	T20S	2	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:57 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns1l-CgV1aTYOP12Jh9gA6LPMgYLeKe720asOa6QXTzLaem

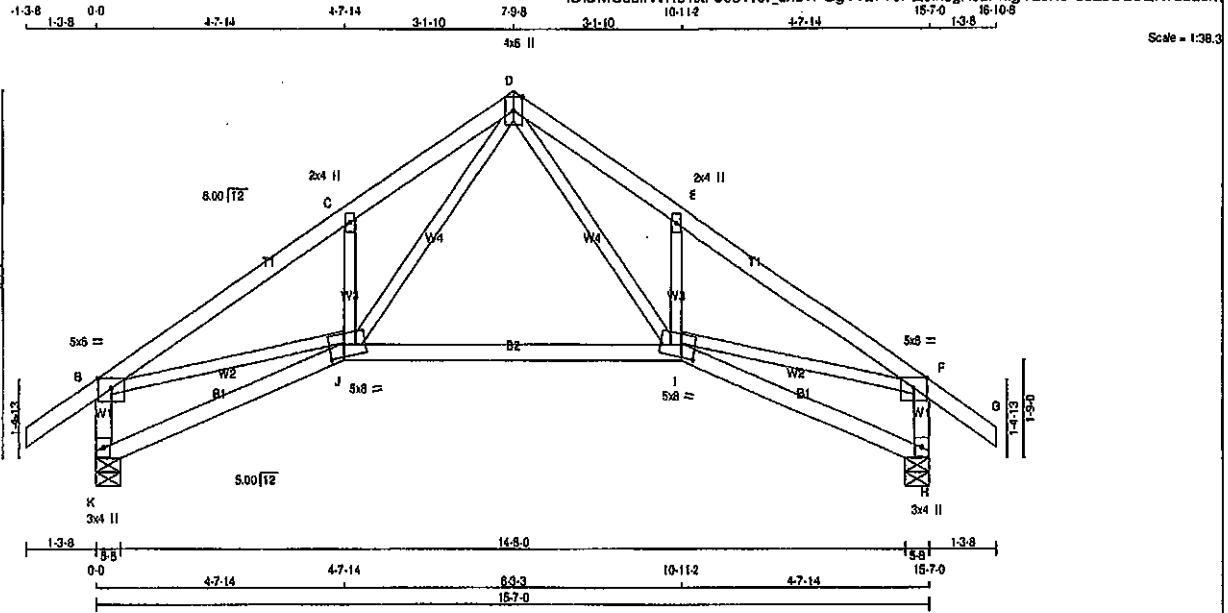

TOTAL WEIGHT = 2 X 68 = 132 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4 DRY	No.2	SPF		
D - G	2x4 DRY	No.2	SPF		
K - B	2x4 DRY	No.2	SPF		
H - F	2x4 DRY	No.2	SPF		
K - J	2x4 DRY	No.2	SPF		
J - I	2x4 DRY	No.2	SPF		
I - H	2x4 DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2
EXCEPT
DRY: SEASONED LUMBER.

PLATES (Labels in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TMW+w	MT20	2.0	4.0		
D	TTWW+p	MT20	4.0	6.0	Edge	
E	TMW+w	MT20	2.0	4.0		
F	TMVW-p	MT20	5.0	8.0	Edge	
H	BMV1+p	MT20	3.0	4.0		
I	BBWWW-m	MT20	5.0	8.0	2.75	3.25
J	BBWWW-m	MT20	5.0	8.0	2.75	3.25
K	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
K	985	0	985	0
H	985	0	985	0

UNFACTORED REACTIONS

1ST CASE	MAX	MIN	COMPONENT REACTIONS	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
K	694	489/0	0/0	0/0	0/0	225/0
H	694	489/0	0/0	0/0	0/0	225/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.16 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX	CS1 (LC)	UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX	CS1 (LC)
FR-TO								FR-TO			
A-B	0/35	-91.8	-91.8	0.12 (1)	10.00	5.18	10.00	D-I	0/880	0.20 (1)	0.20 (1)
B-C	-1445/0	-91.8	-91.8	0.27 (1)	5.18	10.00	5.18	E-F	-445/0	0.08 (1)	0.08 (1)
C-D	-1497/0	-91.8	-91.8	0.19 (1)	5.18	10.00	5.18	J-D	0/880	0.20 (1)	0.20 (1)
D-E	-1497/0	-91.8	-91.8	0.27 (1)	5.18	10.00	5.18	J-C	-445/0	0.08 (1)	0.08 (1)
E-F	-1445/0	-91.8	-91.8	0.12 (1)	10.00	5.18	10.00	B-J	0/1231	0.28 (1)	0.28 (1)
F-G	0/35	-91.8	-91.8	0.12 (1)	10.00	5.18	10.00	I-F	0/1231	0.28 (1)	0.28 (1)
K-B	-942/0	0.0	0.0	0.10 (1)	7.81	10.00	7.81				
H-F	-942/0	0.0	0.0	0.10 (1)	7.81	10.00	7.81				
K-J	0/0	-18.5	-18.5	0.12 (4)	10.00	10.00	10.00				
J-I	0/721	-18.5	-18.5	0.27 (4)	10.00	10.00	10.00				
I-H	0/0	-18.5	-18.5	0.12 (4)	10.00	10.00	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.52")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.52")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CS1: TC=0.27/1.00 (B-C:1), BC=0.27/1.00 (I-J:4), WB=0.28/1.00 (F-I:1), SB=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1867 788 1887 1856


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (F) (INPUT = 0.90)
JSI METAL = 0.30 (I) (INPUT = 1.00)



Structural component only
DWG# T-2008024




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408315	T21	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:59 2020 Page 1

ID:DMCubINVR6TstFoe31v61_zns11-D3do78aGxU11v7J3IXNIR5ea78DeVnG8stbXbMzLaek

14-4-12 14-7-8 14-11-0 2-12-3-8 Scale = 1:23.0

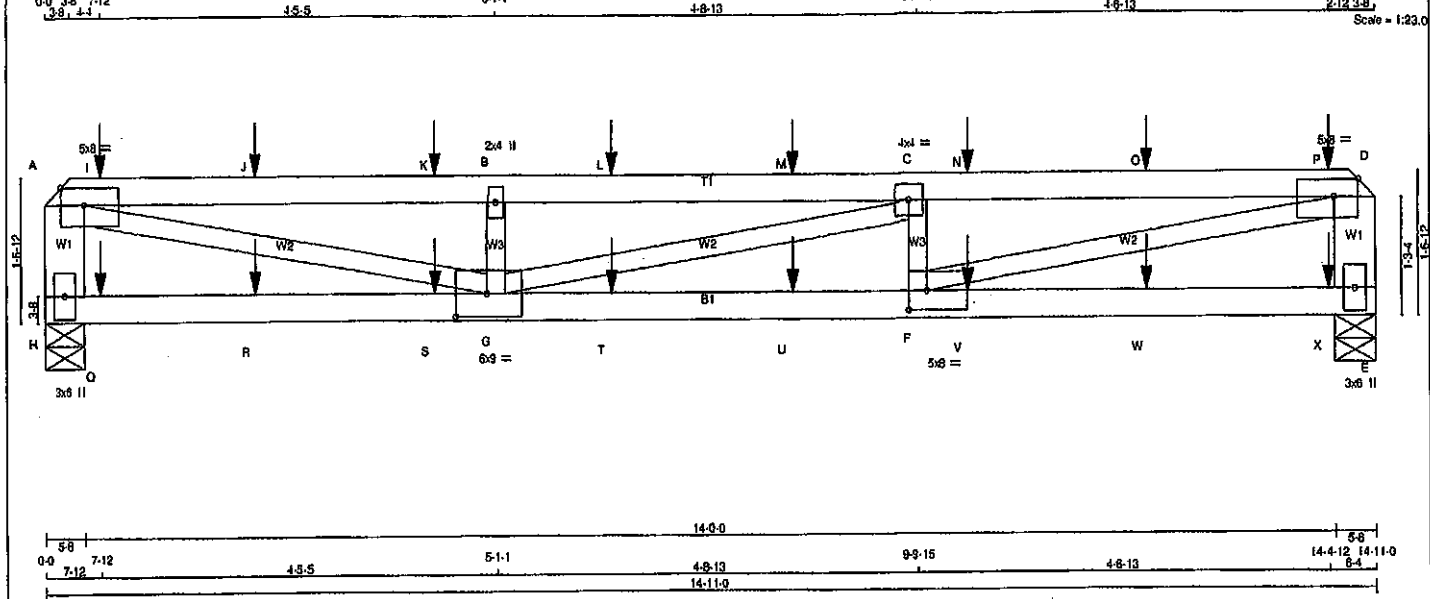

LUMBER				N. L. G. A. RULES	
CHORDS	SIZE	LUMBER	DESCR.	SPF	
A - D	2x4	DRY	No.2	SPF	
H - A	2x6	DRY	No.2	SPF	
E - D	2x6	DRY	No.2	SPF	
H - E	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMW-1	MT20	5.0	8.0	Edge 3.25
B	TMW-1	MT20	2.0	4.0	
C	TMW-1	MT20	4.0	4.0	
D	TMW-1	MT20	5.0	8.0	Edge 3.25
E	BMV1+p	MT20	3.0	8.0	
F	BMW-1	MT20	5.0	8.0	2.50
G	BMW-1	MT20	6.0	9.0	3.00 4.25
H	BMV1+p	MT20	3.0	8.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	DOWN	HORIZ	DOWN	HORIZ	IN-SX	BRG	IN-SX	BRG
H	1220	0	1220	0	0	5-8	5-8	5-8	5-8
E	1224	0	1224	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX/MIN. COMPONENT REACTIONS		SNOW		LIVE		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	SNOW	LIVE	SNOW	LIVE	SNOW	LIVE	SNOW	LIVE	SNOW	LIVE	SNOW	LIVE	SNOW	LIVE
H	883	588 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0
E	885	588 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.08 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		FR-TO		FROM TO	
A-I	-3298 / 0	-91.8 -91.8 0.73 (1)	3.08	F-D	0 / 3390	0.84 (1)	0.84 (1)
I-J	-3298 / 0	-91.8 -91.8 0.73 (1)	3.08	A-G	0 / 3397	0.84 (1)	0.84 (1)
J-K	-3298 / 0	-91.8 -91.8 0.73 (1)	3.08	F-C	-630 / 0	0.10 (1)	0.10 (1)
K-B	-3298 / 0	-91.8 -91.8 0.73 (1)	3.08	G-B	-632 / 0	0.10 (1)	0.10 (1)
B-L	-3298 / 0	-91.8 -91.8 0.55 (1)	3.31	G-C	0 / 7	0.00 (1)	0.00 (1)
L-M	-3298 / 0	-91.8 -91.8 0.55 (1)	3.31				
M-C	-3298 / 0	-91.8 -91.8 0.55 (1)	3.31				
C-N	-3289 / 0	-91.8 -91.8 0.71 (1)	3.09				
N-O	-3289 / 0	-91.8 -91.8 0.71 (1)	3.09				
O-P	-3289 / 0	-91.8 -91.8 0.71 (1)	3.09				
P-D	-3289 / 0	-91.8 -91.8 0.71 (1)	3.09				
H-A	-1113 / 0	0.0 0.0 0.08 (1)	7.81				
E-D	-1118 / 0	0.0 0.0 0.08 (1)	7.81				
H-Q	0 / 0	-18.5 -18.5 0.19 (1)	10.00				
Q-R	0 / 0	-18.5 -18.5 0.19 (1)	10.00				
R-S	0 / 0	-18.5 -18.5 0.19 (1)	10.00				
S-G	0 / 0	-18.5 -18.5 0.19 (1)	10.00				
G-T	0 / 3289	-18.5 -18.5 0.71 (1)	10.00				
T-U	0 / 3289	-18.5 -18.5 0.71 (1)	10.00				
U-F	0 / 3289	-18.5 -18.5 0.71 (1)	10.00				
F-V	0 / 0	-18.5 -18.5 0.19 (1)	10.00				
V-W	0 / 0	-18.5 -18.5 0.19 (1)	10.00				
W-X	0 / 0	-18.5 -18.5 0.19 (1)	10.00				
X-E	0 / 0	-18.5 -18.5 0.19 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)				FACE				DIR.				TYPE				HEEL				CONN.			
JT	LOC.	LC1	MAX.	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---
I	7-12	-71	-71	---	---	---	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---
J	2-4-12	-54	-54	---	---	---	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---
K	4-4-12	-54	-54	---	---	---	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---
L	6-4-12	-54	-54	---	---	---	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---
M	8-4-12	-54	-54	---	---	---	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---
N	10-4-12	-54	-54	---	---	---	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---
O	12-4-12	-54	-54	---	---	---	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---
P	14-4-12	-78	-78	---	---	---	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---
Q	7-12	-43	-43	---	---	---	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---
R	2-4-12	-40	-40	---	---	---	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---
S	4-4-12	-40	-40	---	---	---	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---
T	6-4-12	-40	-40	---	---	---	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---
U	8-4-12	-40	-40	---	---	---	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---
V	10-4-12	-40	-40	---	---	---	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---
W	12-4-12	-40	-40	---	---	---	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---	FRONT	VERT	TOTAL	---

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2010
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.50")
CALCULATED VERT. DEFL.(LL) = L/882 (0.20")
ALLOWABLE DEFL.(TL) = L/360 (0.50")
CALCULATED VERT. DEFL.(TL) = L/477 (0.38")

CSI: TC=0.73/1.00 (A-B:1), BC=0.71/1.00 (F-G:1),
WB=0.84/1.00 (A-G:1), SSI=0.31/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 L8 SEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (G) (INPUT = 0.80)
JSI METAL= 0.62 (A) (INPUT = 1.00)

CONTINUED ON PAGE 2

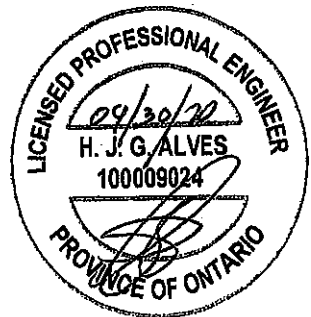

Structural component only
DWG# T-2008025 1/2

JOB NAME 408315	TRUSS NAME T21	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Thu Apr 30 09:31:59 2020 Page 2

ID:DMCubINVR6TstFoe31v6l zns1l-D3do78aGxUl1v7J3IXNIR5ea78DeWnG9stbXbMzLapK

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
X	14-4-12	-44	-44	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2008025 7/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T30	1	2	GREEN PARK HOMES	


Famarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:05:23 2020 Page 1

ID:DMCubINVR6TslFoe31v6l_zns11-XbiObQj7DnhK2WChPKqhe9rzD3Ac7gg2axCzLa9Q

23-2-8 31-7-8 33-0-4 35-1-0 36-4-8

Scale = 1/8" = 1'-0"

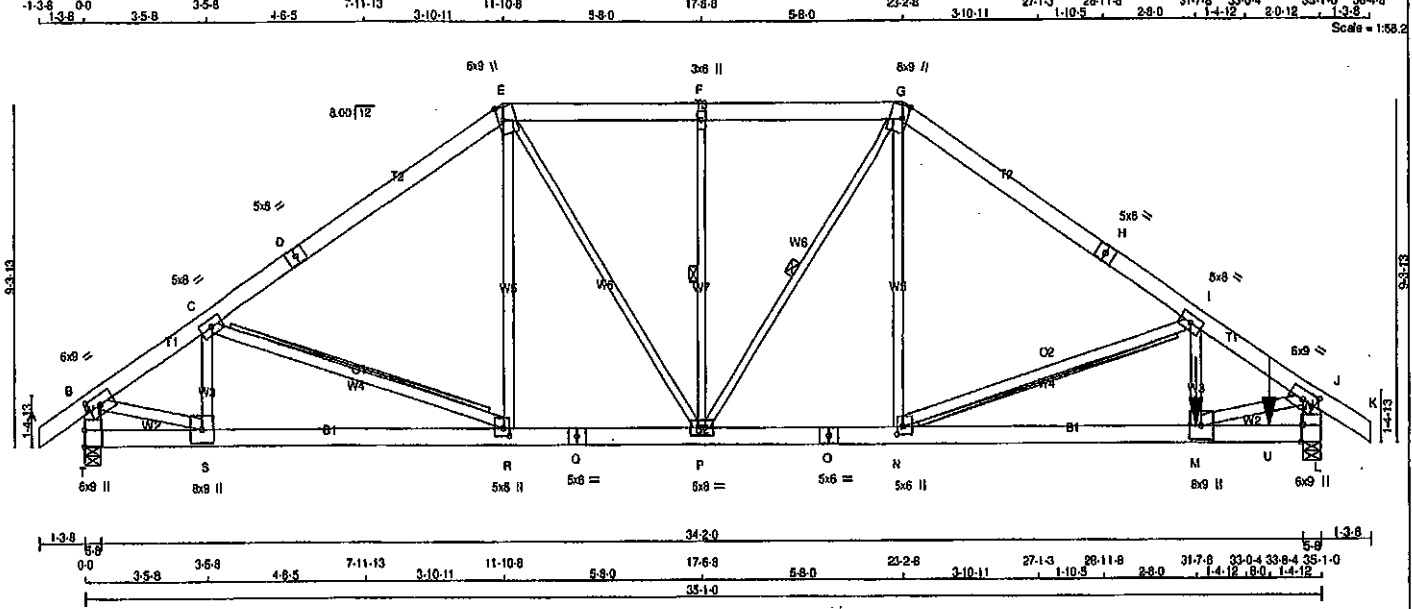

TOTAL WEIGHT = 2 X 219 = 437 lb

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x6	DRY No.2	SPF
D - E	2x6	DRY No.2	SPF
E - G	2x6	DRY No.2	SPF
G - H	2x6	DRY No.2	SPF
H - K	2x6	DRY No.2	SPF
T - B	2x6	DRY No.2	SPF
L - J	2x6	DRY No.2	SPF
T - Q	2x6	DRY No.2	SPF
Q - O	2x6	DRY No.2	SPF
O - L	2x6	DRY No.2	SPF
ALL WEBS EXCEPT	2x4	DRY No.2	SPF
P - G	2x3	DRY No.2	SPF
E - P	2x3	DRY No.2	SPF
P - F	2x3	DRY No.2	SPF


DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122'X3') SPIRAL NAILS		
A-D 2	12	TOP
D-E 2	12	TOP
E-G 2	12	TOP
G-H 2	12	TOP
H-K 2	12	TOP
T-B 2	12	TOP
L-J 2	12	TOP
BOTTOM CHORDS: (0.122'X3') SPIRAL NAILS		
T-Q 2	12	TOP
Q-O 2	12	TOP
O-L 2	12	TOP
WEBS: (0.122'X3') SPIRAL NAILS		
2x3 1	6	SIDE(183.1)
M-I 2	2	SIDE(1289.7)
2x4 1	6	
S-C 2	2	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

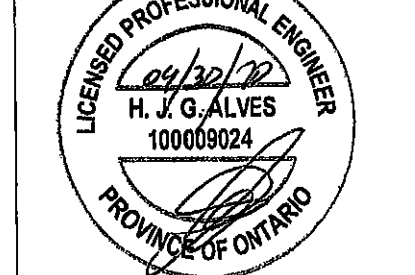

Structural component only
DWG# T-2008029 1/2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQ'D BRG
JT VERT	2640	0	0	5-8
T	2640	0	0	5-8
L	7741	0	0	5-8

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	1864	1241 / 0
T	5484	3843 / 0
L		0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.85 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-P, F-P.
2x4 DRY SPF No.2 T-BRACE AT C-P
2x8 DRY SPF No.2 T-BRACE AT I-N

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)	MAX. FACTORED VERT. LOAD (LC4)	MAX. FACTORED VERT. LOAD (LC5)	MAX. FACTORED VERT. LOAD (LC6)	MAX. FACTORED VERT. LOAD (LC7)	MAX. FACTORED VERT. LOAD (LC8)	MAX. FACTORED VERT. LOAD (LC9)	MAX. FACTORED VERT. LOAD (LC10)
FR-TO												
A-B	0 / 36	-91.8	-91.8	0.04 (1)	10.00	C-R	-188 / 0	0.07 (1)				
B-C	-3133 / 0	-91.8	-91.8	0.22 (1)	5.86	P-E	0 / 236	0.03 (4)				
C-D	-3051 / 0	-91.8	-91.8	0.25 (1)	6.02	N-G	0 / 1853	0.18 (1)				
D-E	-3051 / 0	-91.8	-91.8	0.25 (1)	6.02	N-I	-4718 / 0	0.82 (1)				
E-F	-3089 / 0	-91.8	-91.8	0.13 (1)	6.12	P-G	-302 / 0	0.12 (1)				
F-G	-3089 / 0	-91.8	-91.8	0.13 (1)	6.12	E-P	0 / 1075	0.13 (1)				
G-H	-3802 / 0	-91.8	-91.8	0.31 (1)	5.43	P-F	-605 / 0	0.16 (1)				
H-I	-3802 / 0	-91.8	-91.8	0.31 (1)	5.43	S-C	-598 / 0	0.05 (1)				
I-J	-9121 / 0	-91.8	-91.8	0.28 (1)	3.85	B-S	0 / 2770	0.24 (1)				
J-K	0 / 36	-91.8	-91.8	0.04 (1)	10.00	M-I	0 / 3891	0.34 (1)				
T-B	-2810 / 0	0.0	0.0	0.09 (1)	7.81	M-J	0 / 7892	0.70 (1)				
L-J	-7254 / 0	0.0	0.0	0.28 (1)	5.85							
T-S	0 / 0	-18.5	-18.5	0.04 (4)	10.00							
S-R	0 / 2682	-18.5	-18.5	0.22 (1)	10.00							
R-Q	0 / 2509	-18.5	-18.5	0.21 (1)	10.00							
Q-P	0 / 2509	-18.5	-18.5	0.21 (1)	10.00							
P-O	0 / 3253	-18.5	-18.5	0.27 (1)	10.00							
O-N	0 / 3253	-18.5	-18.5	0.27 (1)	10.00							
N-M	0 / 7639	-18.5	-18.5	0.57 (1)	10.00							
M-U	0 / 0	-18.5	-18.5	0.24 (1)	10.00							
U-L	0 / 0	-18.5	-18.5	0.24 (1)	10.00							

FACTORED CONCENTRATED LOADS (LBS)	JT LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
M	31-7-8	-5569	-5569	---	BACK	VERT	TOTAL	---	C1
U	33-8-4	-684	-684	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
CALCULATED VERT. DEFL.(LL) = L/999 (0.08')
ALLOWABLE DEFL.(TL) = L/360 (1.17')
CALCULATED VERT. DEFL.(TL) = L/999 (0.16')

CS: TC=0.31/1.00 (G-I:1), BC=0.67/1.00 (M-N:1), WB=0.70/1.00 (J-M:1), GS=0.16/1.00 (L-M:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (R) (INPUT = 0.90)

JSI METAL = 0.86 (R) (INPUT = 1.00)

CONTINUED ON PAGE 2


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-I	MT20	6.0	9.0	3.00	4.25
C	TMWW-I	MT20	5.0	8.0		
D	TS-I	MT20	5.0	6.0		
E	TTWW+m	MT20	6.0	9.0	4.25	1.50
F	TMW+w	MT20	3.0	6.0		
G	TTWW+m	MT20	6.0	9.0	4.25	1.50
H	TS-I	MT20	5.0	6.0		
I	TMWW-I	MT20	5.0	8.0		
J	TMWW-I	MT20	6.0	9.0	3.00	4.25
L	BMV-I	MT20	8.0	9.0	Edge	0.50
M	BMWW-I	MT20	8.0	9.0		
N	BMWW-I	MT20	5.0	6.0	2.50	2.00
O	BS-I	MT20	5.0	6.0		
P	BMWWW-I	MT20	5.0	8.0		
Q	BS-I	MT20	5.0	6.0		
R	BMWW-I	MT20	5.0	6.0	2.50	2.00
S	BMWW-I	MT20	8.0	9.0		
T	BMV-I	MT20	6.0	9.0	5.50	


Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

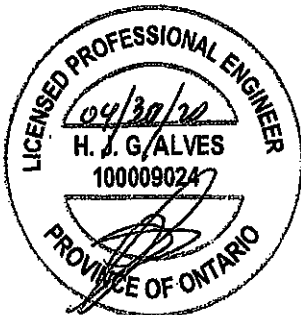

Structural component only
DWG# T-2008029 1/2

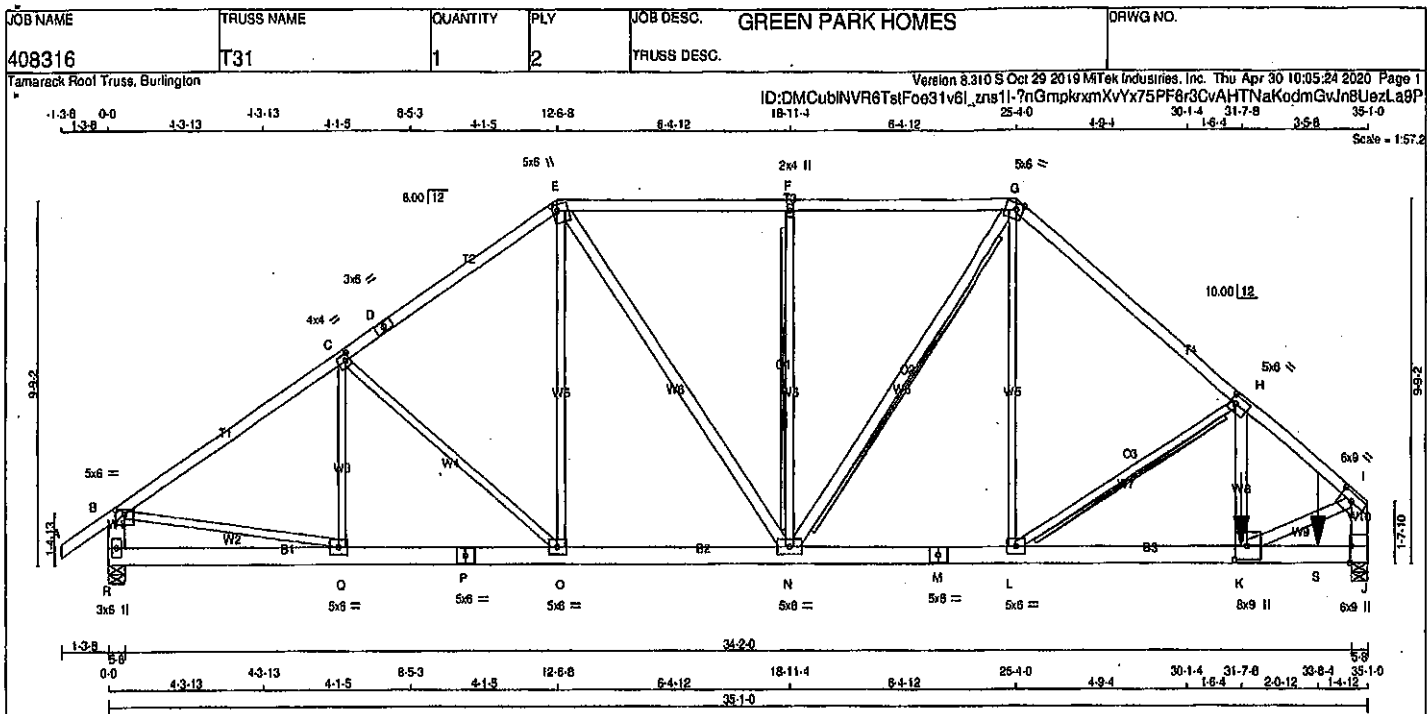

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
I - J	2x6	DRY	No.2	SPF
J - K	2x6	DRY	No.2	SPF
K - P	2x6	DRY	No.2	SPF
P - M	2x6	DRY	No.2	SPF
M - J	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
K - H	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
N - G	2x4	DRY	No.2	SPF
E - N	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-D 1	12	TOP
D-E 1	12	TOP
E-G 1	12	TOP
G-I 1	12	TOP
I-J 2	12	TOP
J-K 2	12	TOP
K-P 2	12	TOP
P-M 2	12	TOP
M-J 2	12	TOP
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1	6	SIDE(183.1)
H-K 2	3	SIDE(1410.3)
2x4 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQ'D BRG
JT VERT	2689	0	5-8
R	2689	0	5-8
J	8097	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX/MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
R	1899 1284 / 0 0 / 0 0 / 0 635 / 0 0 / 0
J	5718 3798 / 0 0 / 0 0 / 0 1920 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.04 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x6 DRY SPF No.2 T-BRACE AT H-L, G-N

2x4 DRY SPF No.2 T-BRACE AT F-N

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.07 (1)	10.00	Q-C	-321 / 0	0.08 (1)
B-C	-3291 / 0	-91.8	-91.8 0.49 (1)	4.68	C-O	-345 / 0	0.24 (1)
C-D	-3058 / 0	-91.8	-91.8 0.45 (1)	4.82	O-E	0 / 358	0.04 (1)
D-E	-3058 / 0	-91.8	-91.8 0.45 (1)	4.82	L-G	0 / 2223	0.28 (1)
E-F	-3118 / 0	-91.8	-91.8 0.44 (1)	4.78	L-H	-3908 / 0	0.70 (1)
F-G	-3118 / 0	-91.8	-91.8 0.44 (1)	4.78	B-Q	0 / 2801	0.35 (1)
G-H	-4128 / 0	-91.8	-91.8 0.49 (1)	4.38	K-H	0 / 4142	0.37 (1)
H-I	-8211 / 0	-91.8	-91.8 0.51 (1)	3.04	K-I	0 / 6730	0.59 (1)
I-B	-2628 / 0	0.0	0.0 0.09 (1)	7.81	N-G	-56 / 0	0.02 (1)
J-I	-7603 / 0	0.0	0.0 0.28 (1)	5.44	E-N	0 / 1075	0.10 (1)
				N-F	-711 / 0	0.34 (1)	
R-O	0 / 0	-18.5	-18.5 0.05 (4)	10.00			
O-P	0 / 2789	-18.5	-18.5 0.20 (1)	10.00			
P-O	0 / 2789	-18.5	-18.5 0.20 (1)	10.00			
O-N	0 / 2512	-18.5	-18.5 0.18 (1)	10.00			
N-M	0 / 3167	-18.5	-18.5 0.24 (1)	10.00			
M-L	0 / 3167	-18.5	-18.5 0.24 (1)	10.00			
L-K	0 / 6348	-18.5	-18.5 0.48 (1)	10.00			
K-S	0 / 0	-18.5	-18.5 0.25 (1)	10.00			
S-J	0 / 0	-18.5	-18.5 0.25 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
K	31-7.8	-6108	-6108	---	FRONT	VERT	TOTAL	CI
S	33-8.4	-684	-684	---	FRONT	VERT	TOTAL	CI

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")

CALCULATED VERT. DEFL.(LL) = L/999 (0.08")

ALLOWABLE DEFL.(TL) = L/360 (1.17")

CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.51/1.00 (H-L:1), BC=0.48/1.00 (K-L:1), WB=0.70/1.00 (H-L:1), SS=0.18/1.00 (J-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1887 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.88 (E) (INPUT = 0.90)

JSI METAL=0.72 (K) (INPUT = 1.00)



Structural component only


DWG#, T-2008030

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408316	T32	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:05:25 2020 Page 1

ID:DMCubINVR6TsIFoe31v6I_znst1-T_q8039eZXq1PZHgboqMik6JmPmxDX7wQ8ZXh04zLa9C

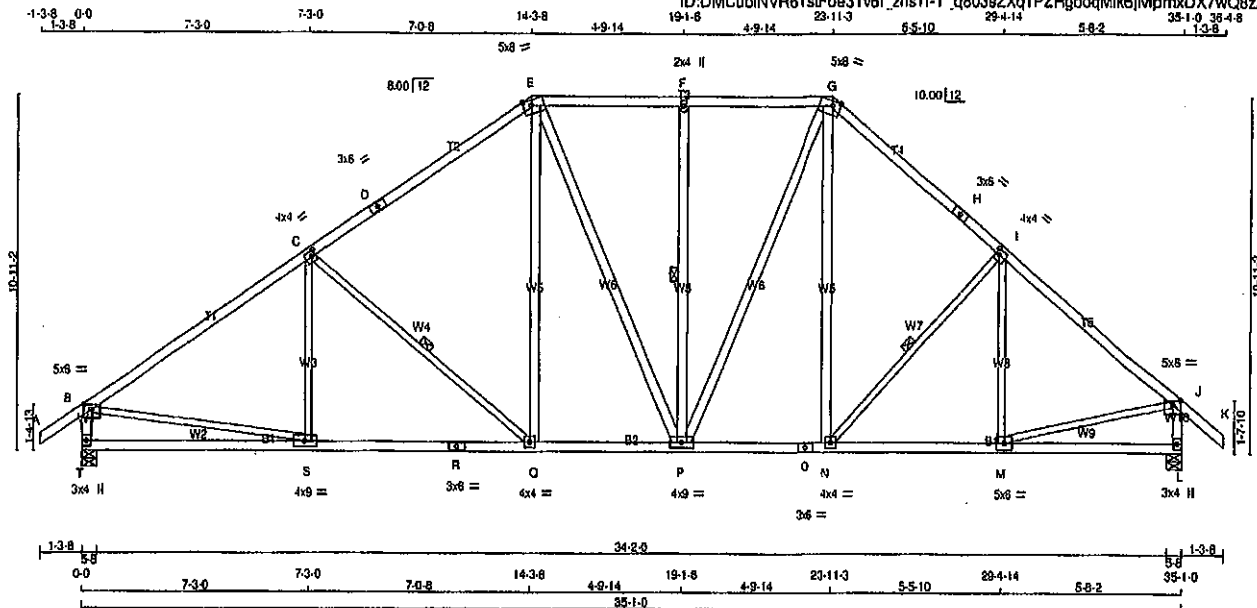


Scale = 1/8" = 1'-0"

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - G	2x4	DRY	No.2	SPF	
G - H	2x4	DRY	No.2	SPF	
H - I	2x4	DRY	No.2	SPF	
I - J	2x4	DRY	No.2	SPF	
J - K	2x4	DRY	No.2	SPF	
L - M	2x4	DRY	No.2	SPF	
M - N	2x4	DRY	No.2	SPF	
N - O	2x4	DRY	No.2	SPF	
O - L	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x4	DRY	No.2	SPF	
S - C	2x3	DRY	No.2	SPF	
C - Q	2x3	DRY	No.2	SPF	
N - I	2x3	DRY	No.2	SPF	
M - J	2x3	DRY	No.2	SPF	
B - S	2x3	DRY	No.2	SPF	
M - J	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.75	2.75
C	TMVW-l	MT20	4.0	4.0	2.00	1.50
D	TS-l	MT20	3.0	6.0		
E	TTWW-m	MT20	5.0	8.0	2.00	3.00
F	TMVW-w	MT20	2.0	4.0		
G	TTWW-m	MT20	5.0	8.0	Edges	3.00
H	TS-l	MT20	3.0	6.0		
I	TMVW-l	MT20	4.0	4.0	2.00	1.25
J	TMVW-p	MT20	6.0	8.0	1.50	3.00
L	BMVl+p	MT20	3.0	4.0		
M	BMVW-l	MT20	5.0	8.0		
N	BMVW-l	MT20	4.0	4.0		
O	BS-l	MT20	3.0	6.0		
P	BMVW-w	MT20	4.0	9.0		
Q	BMVW-l	MT20	4.0	4.0		
R	BS-l	MT20	3.0	6.0		
S	BMVW-l	MT20	4.0	9.0		
T	BMVl+p	MT20	3.0	4.0		

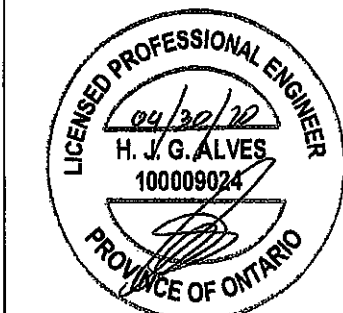

Structural component only
DWG# T-2008031

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	SRG	BRG
JT	VERT	HORZ	DOWN	HORZ
T	2060	0	2060	0
L	2061	0	2061	0

UNFACTORED REACTIONS

1ST LOASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	1454	988 / 0	0 / 0	0 / 0	487 / 0	0 / 0
L	1455	988 / 0	0 / 0	0 / 0	487 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.53 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-Q, F-P, I-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX	MAX	WEBS	MAX. FACTORED	MAX
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 (LC)	UNBRAC	MEMB.	FORCE (LBS)	MAX (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	S-C	-146 / 72
B-C	-2352 / 0	-91.8	-91.8	0.85 (1)	3.53	C-Q	-585 / 0
C-D	-1899 / 0	-91.8	-91.8	0.75 (1)	3.96	Q-E	0 / 484
D-E	-1899 / 0	-91.8	-91.8	0.75 (1)	3.96	E-P	0 / 145
E-F	-1606 / 0	-91.8	-91.8	0.30 (1)	4.80	P-F	-536 / 0
F-G	-1606 / 0	-91.8	-91.8	0.30 (1)	4.80	P-G	0 / 526
G-H	-1848 / 0	-91.8	-91.8	0.45 (1)	4.49	N-G	0 / 318
H-I	-1848 / 0	-91.8	-91.8	0.45 (1)	4.49	N-I	-302 / 0
I-J	-2032 / 0	-91.8	-91.8	0.48 (1)	4.28	M-I	-250 / 9
J-K	0 / 41	-91.8	-91.8	0.13 (1)	10.00	B-S	0 / 2015
T-B	-2005 / 0	0.0	0.0	0.21 (1)	5.96	M-J	0 / 1633
L-J	-2017 / 0	0.0	0.0	0.21 (1)	5.94		
T-S	0 / 0	-18.5	-18.5	0.24 (4)	10.00		
S-R	0 / 1993	-18.5	-18.5	0.44 (1)	10.00		
R-Q	0 / 1993	-18.5	-18.5	0.44 (1)	10.00		
Q-P	0 / 1548	-18.5	-18.5	0.32 (1)	10.00		
P-O	0 / 1390	-18.5	-18.5	0.28 (1)	10.00		
O-N	0 / 1390	-18.5	-18.5	0.28 (1)	10.00		
N-M	0 / 1581	-18.5	-18.5	0.32 (1)	10.00		
M-L	0 / 0	-18.5	-18.5	0.14 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CSI: TC=0.85/1.00 (B-C:1), BC=0.44/1.00 (Q-S:1), WB=0.45/1.00 (B-S:1), SS=0.27/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 789 1987 1856

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.69 (J) (INPUT = 0.90)
JSI METAL= 0.67 (R) (INPUT = 1.00)

JOB NAME 408316	TRUSS NAME T33	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 28 2019 MTek Industries, Inc. Thu Apr 30 10:05:25 2020 Page 1

ID:DMCubINVR6TslFoe31v6I_zns11-T_q803sZXq1PZHgbogMik6QPmxIX7qQ8zXh04zLa9C

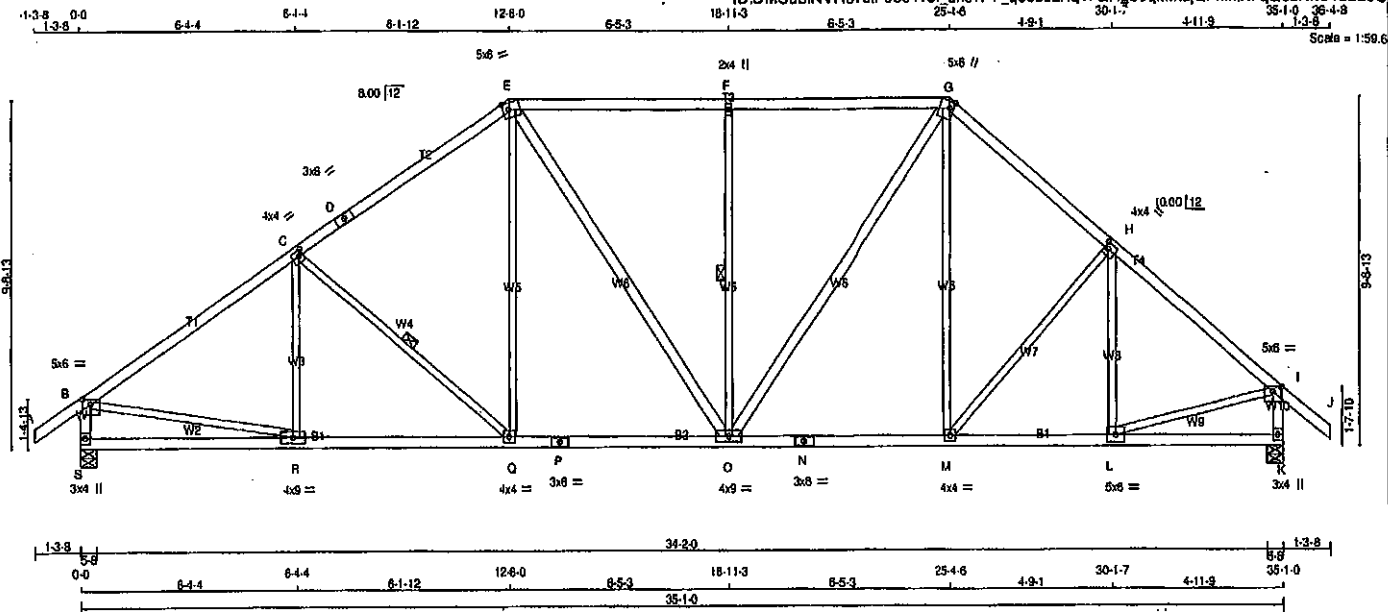

TOTAL WEIGHT = 170 lb

LUMBER	N L G A RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - G	2x4	DRY	No.2	SPF	
G - J	2x4	DRY	No.2	SPF	
S - B	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
S - P	2x4	DRY	No.2	SPF	
P - N	2x4	DRY	No.2	SPF	
N - K	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
E - O	2x4	DRY	No.2	SPF	
O - G	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TMVW-l	MT20	4.0	4.0	2.00	1.50
D	TS-l	MT20	3.0	6.0		
E	TTWW-m	MT20	5.0	6.0	2.25	2.00
F	TMVW-w	MT20	2.0	4.0		
G	TTWW-m	MT20	5.0	6.0	2.25	1.50
H	TMVW-l	MT20	4.0	4.0	2.00	1.25
I	TMVW-p	MT20	5.0	6.0	1.50	3.00
K	BMV1+p	MT20	3.0	4.0		
L	BMVW-l	MT20	5.0	6.0		
M	BMVW-l	MT20	4.0	4.0		
N	BS-l	MT20	3.0	6.0		
O	BMVW-l	MT20	4.0	9.0		
P	BS-l	MT20	3.0	6.0		
Q	BMVW-l	MT20	4.0	4.0		
R	BMVW-l	MT20	4.0	9.0		
S	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
S	2060	0	2060	0	5-8
K	2061	0	2061	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
S	1454	988 / 0	0 / 0	0 / 0	0 / 0	487 / 0	0 / 0	
K	1455	988 / 0	0 / 0	0 / 0	0 / 0	487 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-Q, F-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. FACTORED UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (LC)	
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	R-C	-211 / 32	0.10 (1)
B-C	-2349 / 0	-91.8	-91.8 0.82 (1)	3.88	C-Q	-437 / 0	0.20 (1)
C-D	-2028 / 0	-91.8	-91.8 0.58 (1)	4.18	Q-E	0 / 398	0.09 (1)
D-E	-2028 / 0	-91.8	-91.8 0.58 (1)	4.18	E-O	0 / 325	0.05 (1)
E-F	-1840 / 0	-91.8	-91.8 0.55 (1)	4.30	O-F	-723 / 0	0.48 (1)
F-G	-1840 / 0	-91.8	-91.8 0.55 (1)	4.30	G-G	0 / 698	0.11 (1)
G-H	-1921 / 0	-91.8	-91.8 0.34 (1)	4.65	M-G	0 / 243	0.05 (1)
H-I	-2008 / 0	-91.8	-91.8 0.35 (1)	4.48	M-H	-184 / 0	0.19 (1)
I-J	0 / 41	-91.8	-91.8 0.13 (1)	10.00	L-H	-319 / 0	0.16 (1)
S-B	-2011 / 0	0.0	0.0 0.21 (1)	5.95	B-R	0 / 2014	0.45 (1)
K-I	-2021 / 0	0.0	0.0 0.21 (1)	5.94	L-I	0 / 1621	0.36 (1)
S-R	0 / 0	-18.5	-18.5 0.17 (4)	10.00			
R-Q	0 / 1988	-18.5	-18.5 0.40 (1)	10.00			
Q-P	0 / 1657	-18.5	-18.5 0.35 (1)	10.00			
P-O	0 / 1657	-18.5	-18.5 0.35 (1)	10.00			
O-N	0 / 1448	-18.5	-18.5 0.32 (1)	10.00			
N-M	0 / 1448	-18.5	-18.5 0.32 (1)	10.00			
M-L	0 / 1568	-18.5	-18.5 0.32 (1)	10.00			
L-K	0 / 0	-18.5	-18.5 0.09 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.17")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.09")
ALLOWABLE DEFL.(TL) = $L/360$ (1.17")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.17")

CSI: TC = 0.62/1.00 (B-C:1), BC = 0.40/1.00 (Q-R:1), WB = 0.48/1.00 (F-O:1), SB = 0.29/1.00 (E-F:1)

DOL LUMBER = 1.00 NAIL = 1.00 LS BEND = 1.10
COMP = 1.10 SHEAR = 1.10 TENS = 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1667 788
	1987	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (I) (INPUT = 0.80)
JSI METAL = 0.48 (P) (INPUT = 1.00)




Structural component only
DWG# T-2008032

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	ORWG NO.
408316	T34	1	2	TRUSS DESC.		

Tesmarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 11:34:36 2020 Page 1

ID:DMCubINVR6TstFoe31v8l_zns1H-Qf24mc3MwC91cE0m7s76Xrx0d06mB1b_EKJRzLYrr

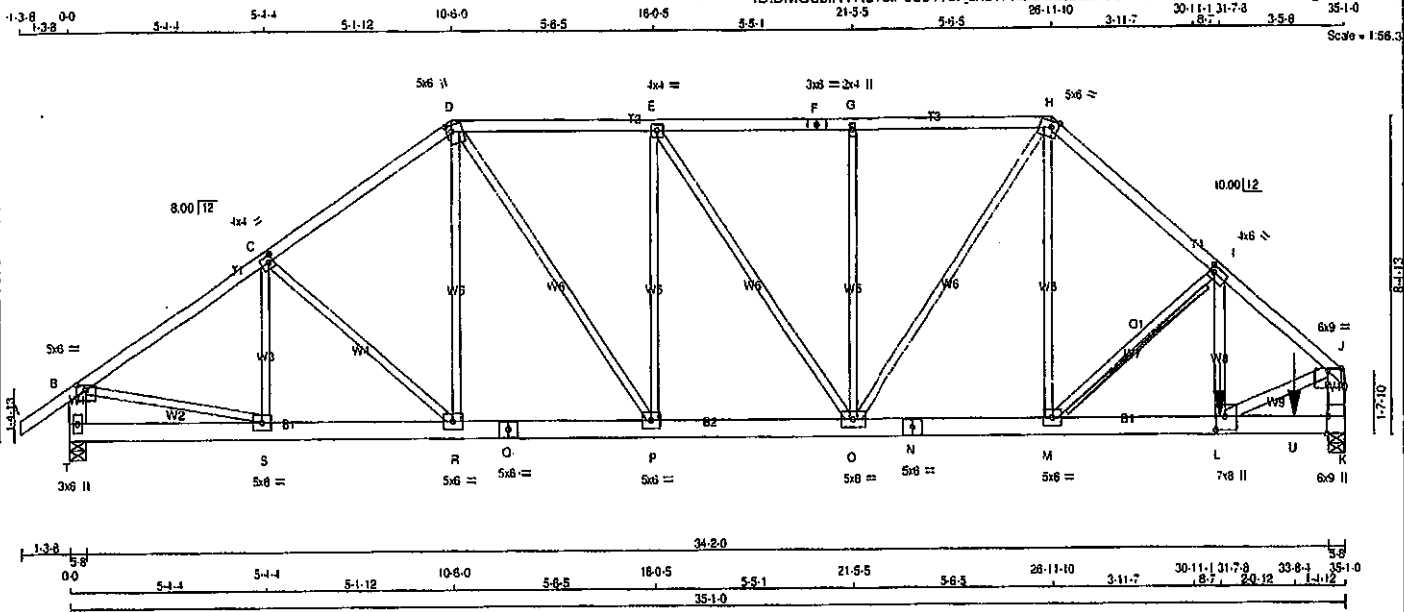

TOTAL WEIGHT = 2 X 187 = 374 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - F	2x4	DRY	No.2	SPF		
F - H	2x4	DRY	No.2	SPF		
H - J	2x4	DRY	No.2	SPF		
J - L	2x4	DRY	No.2	SPF		
L - N	2x4	DRY	No.2	SPF		
N - K	2x4	DRY	No.2	SPF		

ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						
L - I	2x4	DRY	No.2	SPF		
L - J	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : 10.122"x3" SPIRAL NAILS		
A - D	12	TOP
D - F	12	TOP
F - H	12	TOP
H - J	12	TOP
J - L	12	TOP
L - N	12	TOP
N - K	12	TOP
BOTTOM CHORDS : 10.122"x3" SPIRAL NAILS		
T - Q	12	TOP
Q - N	12	TOP
N - K	12	TOP
WEBS : 10.122"x3" SPIRAL NAILS		
2x3	6	SIDE 1183.11
2x4	6	SIDE 1194.0

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	UP	IN-SX
T	2803	0	0	5-8
K	7230	0	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	1837	1223	0	0	0	0
K	5108	3392	0	0	0	1714	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.42 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT I-M

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	CS1 (LBS)	MAX. FACTORED	MEMB.	FORCE (LBS)
FR-TO		FROM TO			FR-TO	
A-B	0 35	-91.8 -91.8 0.07 (1)	10.00	S-C	-416 0	0.07 (1)
B-C	-3111 0	-91.8 -91.8 0.30 (1)	4.96	C-R	-160 0	0.07 (1)
C-D	-3032 0	-91.8 -91.8 0.30 (1)	5.01	R-D	0 231	0.03 (1)
D-E	-3217 0	-91.8 -91.8 0.27 (1)	4.92	D-P	0 1270	0.16 (1)
E-F	-3492 0	-91.8 -91.8 0.28 (1)	4.76	P-E	-951 0	0.64 (1)
F-G	-3492 0	-91.8 -91.8 0.28 (1)	4.75	E-O	0 -492	0.06 (1)
G-H	-3492 0	-91.8 -91.8 0.27 (1)	4.76	O-G	-534 0	0.36 (1)
H-I	-4347 0	-91.8 -91.8 0.28 (1)	4.40	O-H	0 259	0.03 (1)
I-J	-7316 0	-91.8 -91.8 0.33 (1)	3.42	M-H	0 2163	0.27 (1)
J-K	-2546 0	0.0 0.0 0.09 (1)	7.81	M-I	-3065 0	0.58 (1)
K-L	-6805 0	0.0 0.0 0.25 (1)	5.71	L-I	0 3477	0.31 (1)
				S-S	0 2859	0.33 (1)
				L-J	0 5990	0.53 (1)
T-S	0 0	-18.5 -18.5 0.03 (4)	10.00			
S-R	0 2814	-18.5 -18.5 0.19 (1)	10.00			
R-Q	0 2498	-18.5 -18.5 0.19 (1)	10.00			
Q-P	0 2498	-18.5 -18.5 0.19 (1)	10.00			
P-O	0 3217	-18.5 -18.5 0.23 (1)	10.00			
O-N	0 3345	-18.5 -18.5 0.24 (1)	10.00			
N-M	0 3345	-18.5 -18.5 0.24 (1)	10.00			
M-L	0 5840	-18.5 -18.5 0.44 (1)	10.00			
L-U	0 0	-18.5 -18.5 0.21 (1)	10.00			
U-K	0 0	-18.5 -18.5 0.21 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
L	31-7-8	-5279	-5279	---	BACK	VERT	TOTAL	---	C1
U	33-8-4	-580	-580	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CSK: TC=0.33/1.00 (I-J); BC=0.44/1.00 (L-M); WB=0.84/1.00 (E-P); SS=0.14/1.00 (K-L)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1687
	789	1987	1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 3.0 Deg.

JSI GRIP= 0.88 (L); INPUT = 0.90 ;
JSI METAL= 0.73 (L); INPUT = 1.00 ;



Structural component only
DWG# T-2008033 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T34	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 11:34:38 2020 Page 2

ID:DMCubINVR6TslFoe31v6l_zns11-HQI24mc3MwC91cE0m7s76XrddpD6mB1tb_EKJRzLYrn

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.50	3.00
C	TMWW-l	MT20	4.0	4.0	2.00	1.50
D	TTWW+m	MT20	5.0	6.0	2.00	1.50
E	TMWW-l	MT20	4.0	4.0		
F	TS-l	MT20	3.0	6.0		
G	TMW+w	MT20	2.0	4.0		
H	TTWW-m	MT20	5.0	6.0	2.00	2.25
I	TMWW-l	MT20	4.0	6.0	2.00	1.50
J	TMVW-p	MT20	6.0	9.0	Edge	
K	BMV-l	MT20	6.0	9.0	Edge	0.50
L	BMWW-l	MT20	7.0	8.0	4.25	3.00
M, P, R, S						
M	BMWW-l	MT20	5.0	6.0		
N	BS-l	MT20	5.0	6.0		
O	BMWW-l	MT20	5.0	6.0		
Q	BS-l	MT20	5.0	6.0		
T	BMV-l+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.



Structural component only
DWG# T-2008033 42


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T35	1	2	GREEN PARK HOMES	

Temarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:05:26 2020 Page 1

ID:DMCubNVR6tsFos31v61_zns11-uZWHe5uRpPzQkOAUyW7MLzQ_r3kRFsqxLdPzLa9L

1-3-8 0-0 2-9-8 2-9-8 1-9-8 8-4-14 10-10-14 8-0-6 18-11-4 17-2-8 18-11-4 23-6-2 6-4-14 29-11-0 31-7-8 33-11-8 34-5-0 35-8-8 58-13-8 Scale = 1:50.5

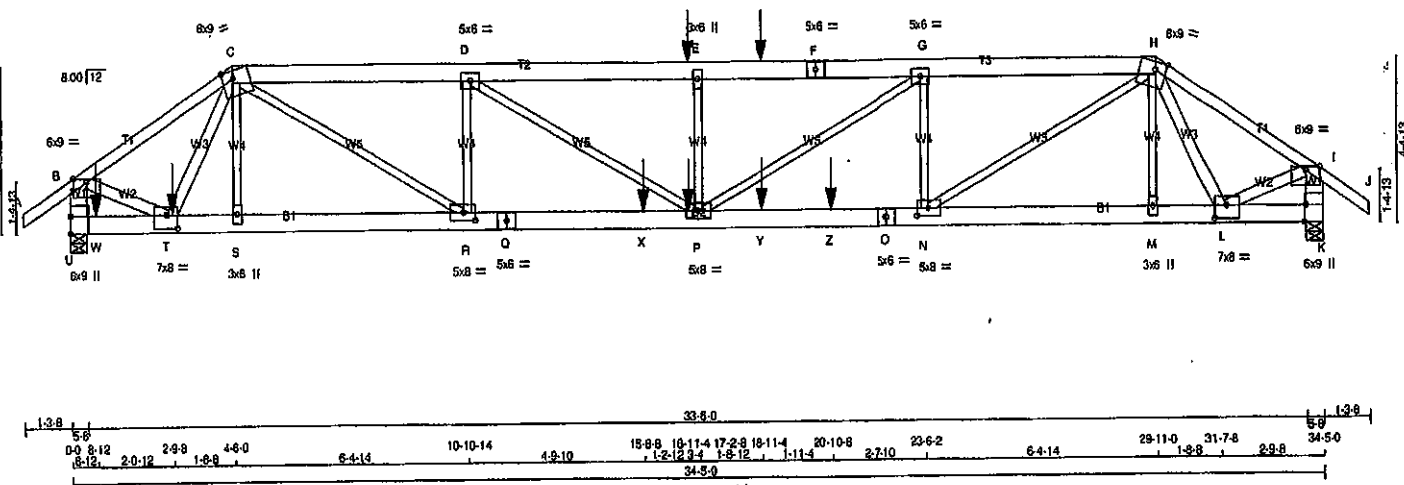

TOTAL WEIGHT = 2 X 178 = 357 lb

LUMBER	SIZE	LUMBER	DESCR.
N. L. G. A. RULES			
CHORDS			
A - C	2x4	DRY	No.2
C - F	2x6	DRY	No.2
F - H	2x6	DRY	No.2
H - J	2x4	DRY	No.2
U - B	2x6	DRY	No.2
K - I	2x6	DRY	No.2
U - Q	2x6	DRY	No.2
Q - O	2x6	DRY	No.2
O - K	2x6	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
L - I	2x4	DRY	No.2
B - T	2x4	DRY	No.2
T - C	2x4	DRY	No.2
H - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
H - J	12	TOP
C - F	12	TOP
F - H	12	TOP
U - B	12	TOP
K - I	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
U - Q	12	SIDE(0.0)
Q - O	12	SIDE(183.1)
O - K	12	TOP
WEBS: (0.122"x3") SPIRAL NAILS		
2x3	6	
2x4	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	HORIZ	UPLIFT
U	7674	0	0	5-8
K	3710	0	0	5-8

UNFACTORED REACTIONS

1ST CASE	MAX / MIN	COMPONENT REACTIONS	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM LIVE	
U	5554	3726 / 0	0 / 0	0 / 0	1826 / 0
K	2815	1766 / 0	0 / 0	0 / 0	849 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.14 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS						WEBS					
MAX. FACTORED		FACTORED				MAX. FACTORED					
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX	CS1 (LC)	UNBRAC	MEMB.	FORCE (LBS)	MAX	CS1 (LC)	
FR-TO		FROM	TO			LENGTH	FR-TO				
A-B	0 / 35	-91.8	-91.8	0.07 (1)	10.00	3.14	S-C	0 / 428	0.05 (1)		
B-C	-8031 / 0	-91.8	-91.8	0.81 (1)	3.14	M-H	0 / 134	0.02 (4)			
C-D	-9185 / 0	-91.8	-91.8	0.30 (1)	3.85	L-I	0 / 3411	0.30 (1)			
D-E	-10772 / 0	-91.8	-91.8	0.32 (1)	3.56	B-T	0 / 7143	0.83 (1)			
E-V	-10772 / 0	-91.8	-91.8	0.36 (1)	3.53	T-C	0 / 1764	0.16 (1)			
V-F	-10772 / 0	-91.8	-91.8	0.36 (1)	3.53	H-L	-1428 / 0	0.17 (1)			
F-G	-10772 / 0	-91.8	-91.8	0.36 (1)	3.53	N-H	0 / 5428	0.67 (1)			
G-H	-8408 / 0	-91.8	-91.8	0.27 (1)	4.02	C-R	0 / 3743	0.46 (1)			
H-I	-3832 / 0	-91.8	-91.8	0.26 (1)	4.60	N-G	-2204 / 0	0.23 (1)			
I-J	0 / 35	-91.8	-91.8	0.07 (1)	10.00	R-D	-1690 / 0	0.22 (1)			
U-B	-7249 / 0	0.0	0.0	0.26 (1)	5.58	P-Q	0 / 2789	0.35 (1)			
K-I	-3633 / 0	0.0	0.0	0.13 (1)	7.37	D-P	0 / 1896	0.23 (1)			
							P-E	-727 / 0	0.10 (1)		
U-W	0 / 0	-18.5	-18.5	0.19 (1)	10.00						
W-T	0 / 0	-18.5	-18.5	0.19 (1)	10.00						
T-S	0 / 5967	-18.5	-18.5	0.58 (1)	10.00						
S-R	0 / 5978	-18.5	-18.5	0.45 (1)	10.00						
R-Q	0 / 9165	-18.5	-18.5	0.93 (1)	10.00						
Q-X	0 / 9165	-18.5	-18.5	0.93 (1)	10.00						
X-P	0 / 9165	-18.5	-18.5	0.93 (1)	10.00						
P-Y	0 / 8408	-18.5	-18.5	0.94 (1)	10.00						
Y-Z	0 / 8408	-18.5	-18.5	0.94 (1)	10.00						
Z-O	0 / 8408	-18.5	-18.5	0.94 (1)	10.00						
O-N	0 / 8408	-18.5	-18.5	0.94 (1)	10.00						
N-M	0 / 3785	-18.5	-18.5	0.38 (1)	10.00						
M-L	0 / 3792	-18.5	-18.5	0.38 (1)	10.00						
L-K	0 / 0	-18.5	-18.5	0.05 (1)	10.00						

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	FACE	DIR.	TYPE	HEEL	CONN.
E	18-11-4	-115	-115	---	FRONT	VERT	TOTAL	C1
P	18-11-4	-23	-23	---	FRONT	VERT	TOTAL	C1
T	2-9-8	-4435	-4435	---	BACK	VERT	TOTAL	C1
V	18-11-4	-115	-115	---	FRONT	VERT	TOTAL	C1
W	8-12	-563	-563	---	BACK	VERT	TOTAL	C1
X	15-8-8	-1259	-1259	---	FRONT	VERT	TOTAL	C1
Y	18-11-4	-23	-23	---	FRONT	VERT	TOTAL	C1
Z	20-10-8	-1006	-1006	---	FRONT	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL	DL = 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.15")
CALCULATED VERT. DEFL.(LL) = L/999 (0.26")
ALLOWABLE DEFL.(TL) = L/360 (1.15")
CALCULATED VERT. DEFL.(TL) = L/881 (0.47")

CS: TC=0.51/1.00 (B-C:1), BC=0.94/1.00 (N-P:1), WB=0.67/1.00 (H-N:1), SS=0.38/1.00 (P-R:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 610 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (N) (INPUT = 0.90)
JSI METAL= 0.84 (Q) (INPUT = 1.00)



Structural component only
DWG# T-2008034 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408316	T35	1	2	TRUSS DESC.		

Tgmarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:05:28 2020 Page 2

ID:DMCubINVR6TsIFog31v8I zns11-uZWHe5uRoiPzQkOAUyw?MILzQ r3kRFsqxILdPzLa9L

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	6.0	9.0	Edge	
C	TTWWV-m	MT20	8.0	9.0	2.50	3.50
D	TMWW-l	MT20	5.0	8.0		
E	TMW+w	MT20	3.0	6.0		
F	TS-l	MT20	5.0	8.0		
G	TMWW-l	MT20	5.0	8.0		
H	TTWWV-m	MT20	8.0	9.0	2.50	3.50
I	TMVW-p	MT20	6.0	9.0	Edge	
K	BMV1+l	MT20	6.0	9.0	Edge	0.60
L	BMWW-l	MT20	7.0	8.0	4.25	3.75
M	BMW+w	MT20	3.0	6.0		
N	BMWW-l	MT20	5.0	8.0	2.50	3.75
O	BS-l	MT20	5.0	6.0		
P	BMWWV-l	MT20	5.0	8.0		
Q	BS-l	MT20	5.0	6.0		
R	BMWW-l	MT20	5.0	8.0	2.50	3.75
S	BMW+w	MT20	3.0	6.0		
T	BMWW-l	MT20	7.0	8.0	4.25	3.75
U	BMV1+l	MT20	6.0	9.0	5.50	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only.
DWG# T-2008034 42

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T36	6	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:05:28 2020 Page 1

ID:DMCubINVR6TslF0e31v6l_zns1l-uZWHe5uRpIPzOkOAUyw?MILvh_zjktWsqxLdPzLa9L

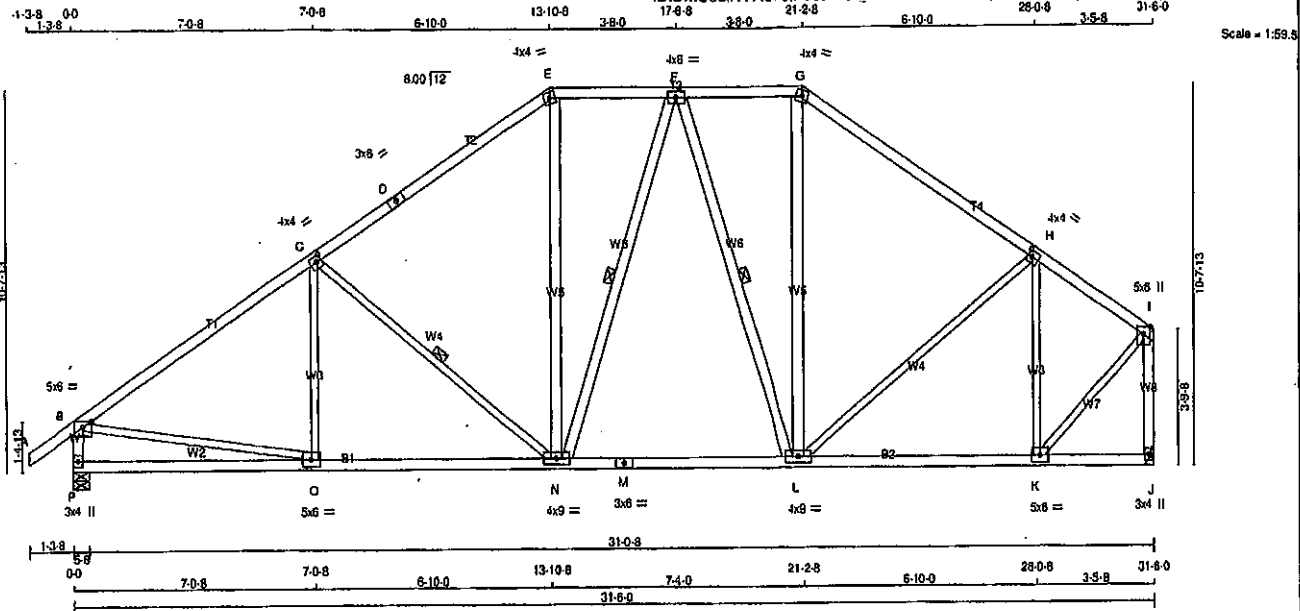

TOTAL WEIGHT = 6 X 184 = 984 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - E	2x4	DRY	No.2	SPF		
E - G	2x4	DRY	No.2	SPF		
G - I	2x4	DRY	No.2	SPF		
I - B	2x4	DRY	No.2	SPF		
J - I	2x4	DRY	No.2	SPF		
P - M	2x4	DRY	No.2	SPF		
M - J	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						
N - E	2x4	DRY	No.2	SPF		
N - F	2x4	DRY	No.2	SPF		
F - L	2x4	DRY	No.2	SPF		
L - G	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (Table 1a in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge	
C	TMVW-i	MT20	4.0	4.0	2.00	1.50
D	TS-i	MT20	3.0	6.0		
E	TTW-m	MT20	4.0	4.0		
F	TMVW-i	MT20	4.0	4.0		
G	TTW-m	MT20	4.0	4.0		
H	TMVW-i	MT20	4.0	4.0	2.00	1.50
I	TMVW-p	MT20	5.0	6.0	Edge	
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-i	MT20	5.0	6.0		
L	BMVWW-i	MT20	4.0	9.0		
M	BS-i	MT20	3.0	6.0		
N	BMVWW-i	MT20	4.0	9.0		
O	BMVW-i	MT20	5.0	6.0		
P	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
P	1862	0	1862	0	5-8
J	1738	0	1738	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
P	1315	876 / 0	0 / 0	0 / 0	0 / 0	439.0	0 / 0
J	1228	806 / 0	0 / 0	0 / 0	0 / 0	422.0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.87 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, F-N, F-L

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED		MEMB.	MAX. FACTORED		
	FORCE	VERT. LOAD	MAX		FORCE	MAX	
	(LBS)	(PLF)	CSI (LC)		(LBS)	CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	10.00	C-C	-128 / 72	0.07 (1)
B-C	-2063 / 0	-91.8	-91.8 0.75 (1)	3.87	C-N	-581 / 0	0.33 (1)
C-D	-1812 / 0	-91.8	-91.8 0.67 (1)	4.38	N-E	0 / 503	0.08 (1)
D-E	-1812 / 0	-91.8	-91.8 0.67 (1)	4.38	N-F	-5 / 32	0.01 (4)
E-F	-1311 / 0	-91.8	-91.8 0.17 (1)	5.48	F-L	-420 / 0	0.27 (1)
F-G	-1177 / 0	-91.8	-91.8 0.16 (1)	5.71	L-G	0 / 393	0.06 (1)
G-H	-1442 / 0	-91.8	-91.8 0.58 (1)	4.73	L-H	0 / 220	0.05 (1)
H-I	-1142 / 0	-91.8	-91.8 0.43 (1)	5.38	K-H	-898 / 0	0.53 (1)
P-B	-1809 / 0	0.0	0.0 0.19 (1)	8.22	B-O	0 / 1772	0.40 (1)
J-I	-1719 / 0	0.0	0.0 0.41 (1)	6.35	K-I	0 / 1420	0.32 (1)
P-O	0 / 0	-18.5	-18.5 0.21 (4)	10.00			
O-N	0 / 1752	-18.5	-18.5 0.39 (1)	10.00			
N-M	0 / 1313	-18.5	-18.5 0.32 (1)	10.00			
M-L	0 / 1313	-18.5	-18.5 0.32 (1)	10.00			
L-K	0 / 1002	-18.5	-18.5 0.27 (4)	10.00			
K-J	0 / 0	-18.5	-18.5 0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6	PSF
DL	= 8.0	PSF
BOT CH. LL	= 0.0	PSF
DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.05")
CALCULATED VERT. DEFL.(LL) = $L/899$ (0.07")
ALLOWABLE DEFL.(TL) = $L/360$ (1.05")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.14")

CSI: TO=0.75/1.00 (B-C:1), EC=0.39/1.00 (N-O:1),
WB=0.53/1.00 (H-K:1), SSI=0.28/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1887
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (B) (INPUT = 0.90)
JSI METAL= 0.45 (I) (INPUT = 1.00)




Structural component only
DWG# T-2008035

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408316	T37	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 M Tek Industries, Inc. Thu Apr 30 10:05:29 2020 Page 1

ID:DMCubINVR6TstFog31v8l_zns1l-MI4sRv3a3Xq2uzM1fREVyu0hOHDTP?2bVv9szLa9K

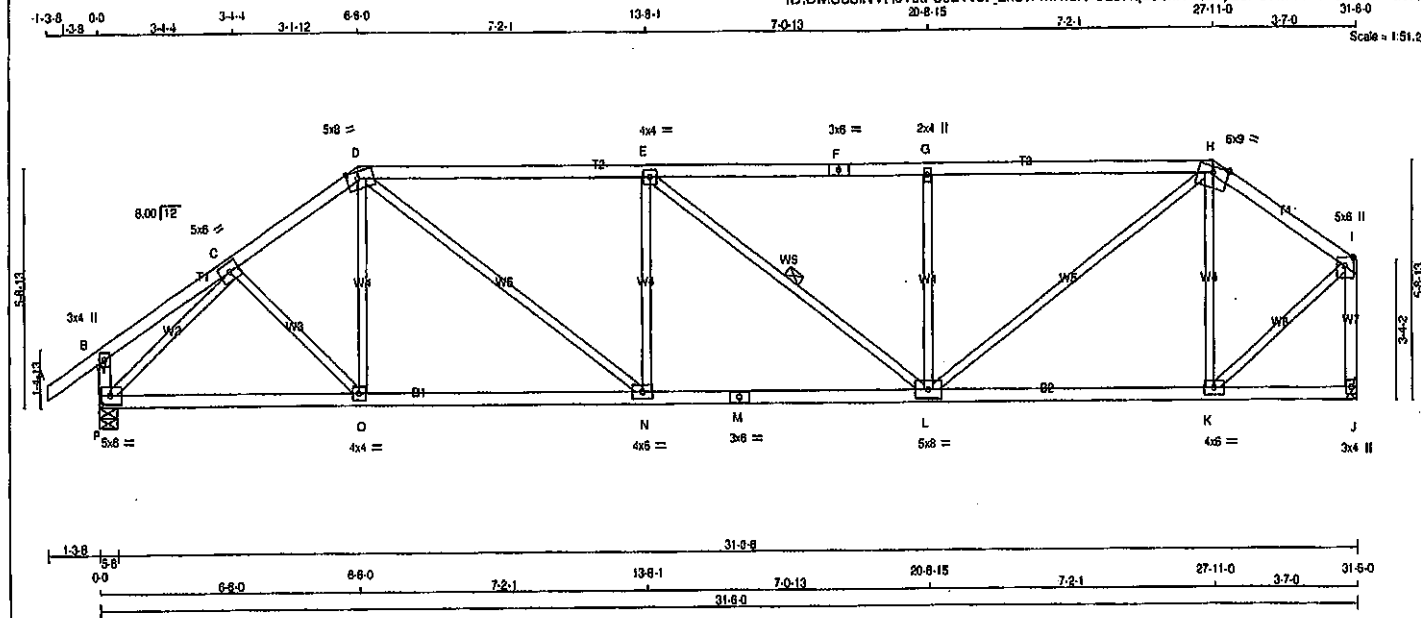

TOTAL WEIGHT = 129 lb

LUMBER	SIZE	DRY	NO.2	DESCR.
CHORDS				
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - I	2x4	DRY	No.2	SPF
J - B	2x4	DRY	No.2	SPF
J - I	2x4	DRY	No.2	SPF
P - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table in inches)	W	LEN	Y	X
JT TYPE				
B TMW+p	MT20	3.0	4.0	
C TMW-w	MT20	5.0	8.0	
D TTW-w	MT20	5.0	8.0	2.00 3.25
E TMW-w	MT20	4.0	4.0	
F TS-1	MT20	3.0	6.0	
G TMW+w	MT20	2.0	4.0	
H TTW-w	MT20	6.0	9.0	Edge
I TMW+p	MT20	5.0	8.0	Edge
J BMV1+p	MT20	3.0	4.0	
K BMW-1	MT20	4.0	6.0	
L BMW-w	MT20	5.0	8.0	
M BS-1	MT20	3.0	6.0	
N BMW-1	MT20	4.0	8.0	
O BMW-w	MT20	4.0	4.0	
P BMW-1	MT20	5.0	8.0	2.50 2.75

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	SNOW	DOWN	UP	IN-SX
P	1862	0	0	5-8
J	1738	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS	DEAD	SOIL
JT COMBINED				
P	1315	876 / 0	0 / 0	439 / 0
J	1228	808 / 0	0 / 0	422 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-L

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PL)	FACTORED GROSS REACTION (PL)	MAX. FACTORED GROSS REACTION (PL)	UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED GROSS REACTION (PL)
FR-TO							FR-TO		
A-B	0.35	-91.8	-91.8	0.12 (1)	10.00	C-O	0.136	0.03 (4)	
B-C	0.18	-91.8	-91.8	0.13 (1)	10.00	D-O	0.97	0.03 (4)	
C-D	-2023 / 0	-91.8	-91.8	0.18 (1)	4.80	D-N	0.1124	0.25 (1)	
D-E	-2564 / 0	-91.8	-91.8	0.99 (1)	3.25	E-N	-551 / 0	0.28 (1)	
E-F	-2355 / 0	-91.8	-91.8	0.93 (1)	3.41	E-L	-263 / 0	0.14 (1)	
F-G	-2355 / 0	-91.8	-91.8	0.93 (1)	3.41	L-G	-711 / 0	0.38 (1)	
G-H	-2355 / 0	-91.8	-91.8	0.93 (1)	3.42	L-H	0.1682	0.37 (1)	
H-I	-1257 / 0	-91.8	-91.8	0.23 (1)	5.47	K-H	-739 / 0	0.37 (1)	
P-S	-246 / 0	0.0	0.0	0.03 (1)	7.81	P-C	-2218 / 0	0.74 (1)	
J-I	-1720 / 0	0.0	0.0	0.33 (1)	6.35	K-I	0.1350	0.30 (1)	
P-O	0.1888	-18.5	-18.5	0.37 (1)	10.00				
O-N	0.1667	-18.5	-18.5	0.38 (1)	10.00				
N-M	0.2684	-18.5	-18.5	0.50 (1)	10.00				
M-L	0.2684	-18.5	-18.5	0.50 (1)	10.00				
L-K	0.1029	-18.5	-18.5	0.27 (4)	10.00				
K-J	0.0	-18.5	-18.5	0.14 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.05")
CALCULATED VERT. DEFL. (LL) = L/999 (0.12")
ALLOWABLE DEFL. (TL) = L/360 (1.05")
CALCULATED VERT. DEFL. (TL) = L/999 (0.25")

CSI: TC=0.89/1.00 (D-E:1), BC=0.50/1.00 (L-N:1),
WB=0.74/1.00 (C-P:1), SSI=0.31/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1867 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (C) (INPUT = 0.90)
JSI METAL = 0.82 (M) (INPUT = 1.00)

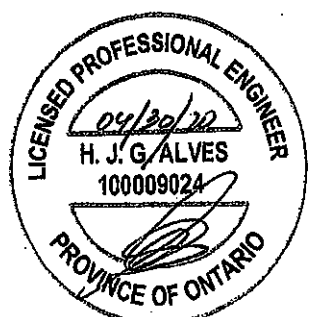


Structural component only
DWG# T-2008036

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408316	T38	1	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:05:30 2020 Page 1
ID:DMCubINVR6TsfFoe31v6I_zns11-qxd13nvlLNh12YzNyTRAQHxne6COU9HFESH1zLa9J

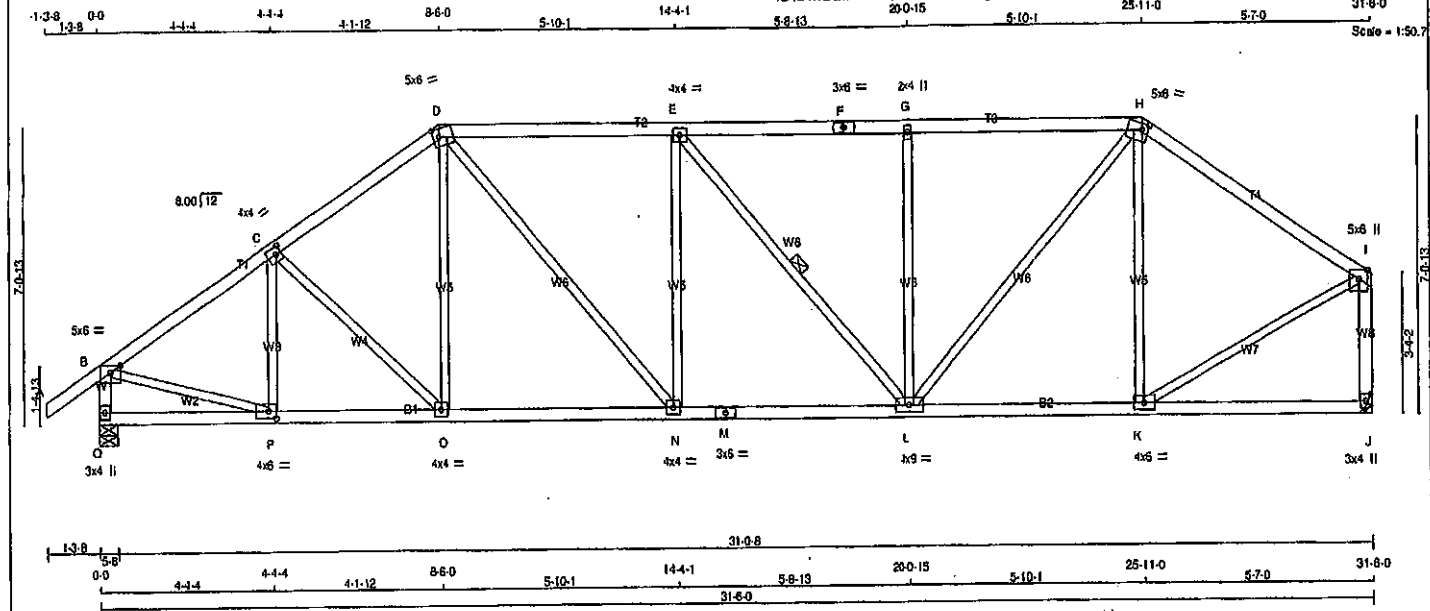

TOTAL WEIGHT = 139 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
A - O	2x4	DRY	No.2		
D - F	2x4	DRY	No.2		
F - H	2x4	DRY	No.2		
H - I	2x4	DRY	No.2		
Q - B	2x4	DRY	No.2		
J - I	2x4	DRY	No.2		
Q - M	2x4	DRY	No.2		
M - J	2x4	DRY	No.2		

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge	
C	TMVW-i	MT20	4.0	4.0	2.00	1.50
D	TTWV-m	MT20	5.0	6.0	2.25	1.75
E	TMVW-i	MT20	4.0	4.0		
F	TS-i	MT20	3.0	6.0		
G	TMVW-m	MT20	2.0	4.0		
H	TTWV-m	MT20	5.0	6.0	1.75	1.75
I	TMVW-p	MT20	5.0	6.0	Edge	
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-i	MT20	4.0	6.0		
L	BMVWV-i	MT20	4.0	9.0		
M	BS-i	MT20	3.0	6.0		
N	BMVW-i	MT20	4.0	4.0		
O	BMVW-i	MT20	4.0	4.0		
P	BMVW-i	MT20	4.0	6.0	2.00	2.25
Q	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
Q	1862	0	1862	0
J	1736	0	1736	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3'-8".

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
Q	1315	876 / 0	0 / 0	0 / 0	0 / 0	0 / 0	439 / 0	0 / 0	0 / 0
J	1228	808 / 0	0 / 0	0 / 0	0 / 0	0 / 0	422 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.14 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO									
A-B	0-35	-91.8	-91.8	0.12 (1)	10.00	P-C	-342 / 0	0.09 (1)	
B-C	-2003 / 0	-91.8	-91.8	0.35 (1)	4.44	C-O	-122 / 0	0.07 (1)	
C-D	-1949 / 0	-91.8	-91.8	0.34 (1)	4.49	O-D	0 / 181	0.04 (4)	
D-E	-2053 / 0	-91.8	-91.8	0.54 (1)	4.14	D-N	0 / 692	0.16 (1)	
E-F	-1915 / 0	-91.8	-91.8	0.53 (1)	4.27	N-E	-414 / 0	0.36 (1)	
F-G	-1915 / 0	-91.8	-91.8	0.53 (1)	4.27	E-L	-215 / 0	0.12 (1)	
G-H	-1914 / 0	-91.8	-91.8	0.52 (1)	4.28	L-G	-576 / 0	0.50 (1)	
H-I	-1442 / 0	-91.8	-91.8	0.80 (1)	4.67	K-H	0 / 1108	0.25 (1)	
Q-B	-1825 / 0	0.0	0.0	0.19 (1)	6.20	K-I	-515 / 0	0.44 (1)	
J-I	-1895 / 0	0.0	0.0	0.32 (1)	6.38	B-P	0 / 1736	0.39 (1)	
Q-P	0 / 0	-18.5	-18.5	0.07 (4)	10.00	K-I	0 / 1357	0.31 (1)	
P-O	0 / 1687	-18.5	-18.5	0.33 (1)	10.00				
O-N	0 / 1601	-18.5	-18.5	0.32 (1)	10.00				
N-M	0 / 2053	-18.5	-18.5	0.40 (1)	10.00				
M-L	0 / 2053	-18.5	-18.5	0.40 (1)	10.00				
L-K	0 / 1190	-18.5	-18.5	0.28 (1)	10.00				
K-J	0 / 0	-18.5	-18.5	0.15 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.05")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (1.05")
CALCULATED VERT. DEFL.(TL) = L/999 (0.17")

CSI: TC=0.60/1.00 (H=1), BC=0.40/1.00 (L=N=1), WB=0.50/1.00 (G=L=1), SB=0.25/1.00 (D=E=1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (B) (INPUT = 0.90)
JSI METAL = 0.59 (M) (INPUT = 1.00)




Structural component only
DWG# T-2008037

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO
408316	T39	1	1	GREEN PARK HOMES	

Truss: Rafter Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 10:05:31 2020 Page 1

ID:DMCubINVR8TstFoe31v61_zns11-H8BPH7wK6gnYHC7194Ti_NzSNB7yxqIWV_?DkzLa8l

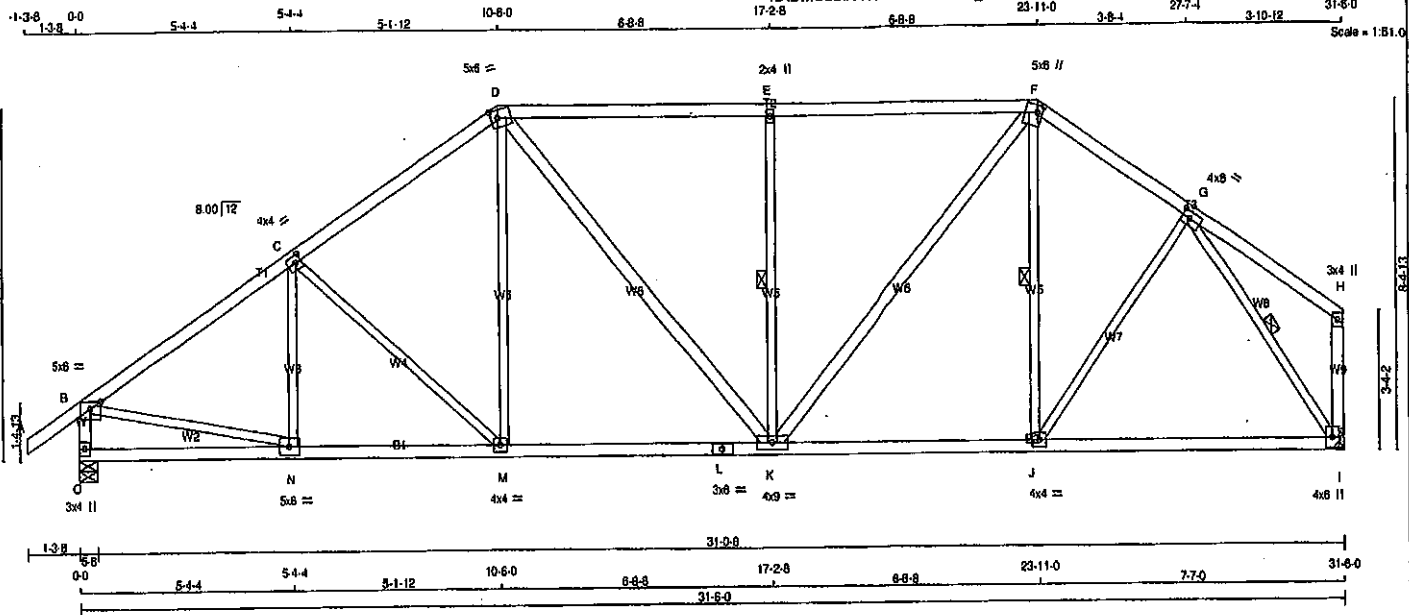

TOTAL WEIGHT = 148 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - F	2x4	DRY	No.2	SPF		
F - H	2x4	DRY	No.2	SPF		
O - B	2x4	DRY	No.2	SPF		
I - H	2x4	DRY	No.2	SPF		
O - L	2x4	DRY	No.2	SPF		
L - I	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						
D - K	2x4	DRY	No.2	SPF		
K - F	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge	
C	TMVW-i	MT20	4.0	4.0	2.00	1.50
D	TMVW-m	MT20	5.0	6.0	2.25	2.00
E	TMVW-w	MT20	2.0	4.0		
F	TMVW-m	MT20	5.0	6.0	2.00	1.50
G	TMVW-i	MT20	4.0	4.0	2.00	2.50
H	TMV-i	MT20	3.0	4.0		
I	BMVW-i-p	MT20	4.0	4.0		
J	BMVW-i	MT20	4.0	4.0		
K	BMVW-i	MT20	4.0	4.0		
L	BS-i	MT20	3.0	6.0		
M	BMVW-i	MT20	4.0	4.0		
N	BMVW-i	MT20	5.0	6.0		
O	BMV-i-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQD
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	BRG	BRG
O	1862	0	1862	0	0	5-8	5-8
I	1738	0	1738	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3'-0.

UNFACTORED REACTIONS

1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
O	1315	876 / 0	0 / 0	0 / 0	0 / 0	439 / 0	0 / 0
I	1228	808 / 0	0 / 0	0 / 0	0 / 0	422 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.32 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-K, F-J, G-I.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO					FR-TO			
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	N-C	-250 / 0	0.09 (1)
B-C	-2050 / 0	-91.8	-91.8	0.40 (1)	4.36	C-M	-302 / 0	0.28 (1)
C-D	-1844 / 0	-91.8	-91.8	0.38 (1)	4.57	M-D	0 / 315	0.07 (1)
D-E	-1740 / 0	-91.8	-91.8	0.59 (1)	4.32	D-K	0 / 382	0.06 (1)
E-F	-1740 / 0	-91.8	-91.8	0.59 (1)	4.32	K-E	-758 / 0	0.34 (1)
F-G	-1527 / 0	-91.8	-91.8	0.19 (1)	5.15	K-F	0 / 771	0.12 (1)
G-H	0 / 22	-91.8	-91.8	0.21 (1)	10.00	J-F	-125 / 39	0.08 (1)
O-B	-1819 / 0	0.0	0.0	0.19 (1)	6.20	J-G	0 / 338	0.08 (1)
I-H	-1367 / 0	0.0	0.0	0.03 (1)	7.81	B-N	0 / 1786	0.40 (1)
						G-I	-1070 / 0	0.57 (1)
O-N	0 / 0	-18.5	-18.5	0.11 (4)	10.00			
N-M	0 / 1731	-18.5	-18.5	0.36 (1)	10.00			
M-L	0 / 1510	-18.5	-18.5	0.32 (1)	10.00			
L-K	0 / 1510	-18.5	-18.5	0.32 (1)	10.00			
K-J	0 / 1249	-18.5	-18.5	0.35 (4)	10.00			
J-I	0 / 1057	-18.5	-18.5	0.33 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 244 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (1.05')
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.07')
ALLOWABLE DEFL. (TL) = $L/360$ (1.05')
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.15')

CSK: TC=0.59/1.00 (D-E:1), BC=0.38/1.00 (M-N:1), WB=0.57/1.00 (G-I), SS=0.30/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LG BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 6.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.80)
JSI METAL= 0.48 (B) (INPUT = 1.00)




Structural component only
DWG# T-2008038

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T40	1	1	GREEN PARK HOMES	

Tagarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:05:31 2020 Page 1

ID:DMCubINVR6TstFoe31v6I_zns1I-18BPH7wK6gnYHC7194Ti_NzSQB7mxs9IWv_7DkzLa9I

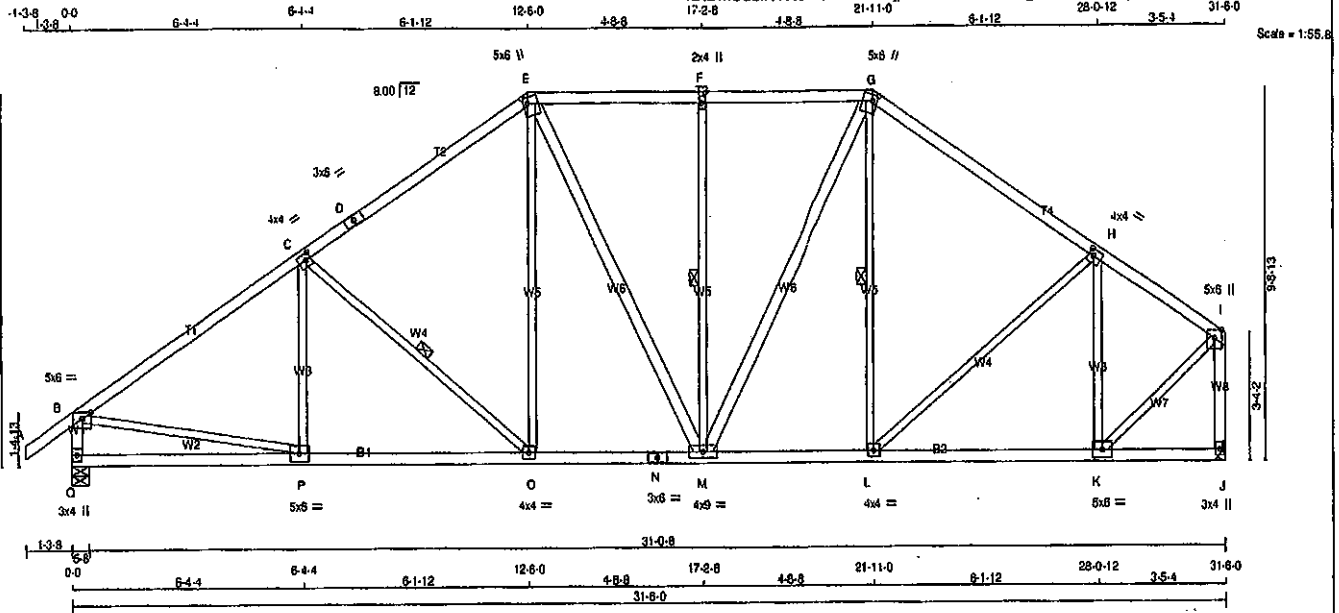

TOTAL WEIGHT = 156 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - E	2x4	DRY	No.2	SPF		
E - G	2x4	DRY	No.2	SPF		
G - I	2x4	DRY	No.2	SPF		
I - J	2x4	DRY	No.2	SPF		
J - K	2x4	DRY	No.2	SPF		
K - L	2x4	DRY	No.2	SPF		
L - M	2x4	DRY	No.2	SPF		
M - N	2x4	DRY	No.2	SPF		
N - J	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						
E - M	2x4	DRY	No.2	SPF		
M - G	2x4	DRY	No.2	SPF		
DRY: SEASONED LUMBER.						

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	6.0	Edge		
C TMVW-l	MT20	4.0	4.0	2.00	1.50	
D TS-l	MT20	3.0	6.0			
E TTWW+m	MT20	5.0	6.0	2.00	1.50	
F TMVW-w	MT20	2.0	4.0			
G TTWW+m	MT20	5.0	6.0	2.00	1.50	
H TMVW-l	MT20	4.0	4.0	2.00	1.50	
I TMVW-p	MT20	5.0	6.0	Edge		
J BMVW+p	MT20	3.0	4.0			
K BMVW-l	MT20	5.0	6.0			
L BMVW-l	MT20	4.0	4.0			
M BMVW-w	MT20	4.0	4.0			
N BS-l	MT20	3.0	6.0			
O BMVW-l	MT20	4.0	4.0			
P BMVW-l	MT20	5.0	6.0			
Q BMVW-p	MT20	3.0	4.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	1862	0	0	5-8
Q	1862	0	0	5-8
J	1738	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3'-8".

UNFACTORED REACTIONS

1ST CASE	MAX/MIN COMPONENT REACTIONS						
JT COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL	
Q	1315	878 / 0	0 / 0	0 / 0	439 / 0	0 / 0	
J	1228	806 / 0	0 / 0	0 / 0	422 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.11 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-Q, F-M, G-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (PLF)	MAX. LC2 (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED MEMB. FORCE (LBS)	MAX. LC1 (PLF)	MAX. LC2 (PLF)
FR-TO						FR-TO			
A-B	0 / 35	-91.8	-91.8	0.12 (1)	10.00	P-C	-168 / 49	0.08 (1)	
B-C	-2068 / 0	-91.8	-91.8	0.59 (1)	4.11	C-Q	-474 / 0	0.22 (1)	
C-D	-1711 / 0	-91.8	-91.8	0.53 (1)	4.49	Q-E	0 / 410	0.09 (1)	
D-E	-1711 / 0	-91.8	-91.8	0.53 (1)	4.49	E-M	0 / 155	0.02 (1)	
E-F	-1463 / 0	-91.8	-91.8	0.28 (1)	5.11	M-F	-525 / 0	0.33 (1)	
F-G	-1463 / 0	-91.8	-91.8	0.28 (1)	5.11	M-G	0 / 513	0.08 (1)	
G-H	-1514 / 0	-91.8	-91.8	0.46 (1)	4.82	L-G	-33 / 66	0.02 (4)	
H-I	-1232 / 0	-91.8	-91.8	0.35 (1)	5.35	L-H	0 / 219	0.05 (1)	
O-B	-1814 / 0	0.0	0.0	0.19 (1)	6.21	K-H	-839 / 0	0.41 (1)	
J-I	-1717 / 0	0.0	0.0	0.33 (1)	6.35	B-P	0 / 1778	0.40 (1)	
						K-I	0 / 1422	0.32 (1)	
Q-P	0 / 0	-18.5	-18.5	0.18 (4)	10.00				
P-O	0 / 1751	-18.5	-18.5	0.37 (1)	10.00				
O-N	0 / 1394	-18.5	-18.5	0.28 (1)	10.00				
N-M	0 / 1394	-18.5	-18.5	0.28 (1)	10.00				
M-L	0 / 1234	-18.5	-18.5	0.27 (1)	10.00				
L-K	0 / 1068	-18.5	-18.5	0.24 (1)	10.00				
K-J	0 / 0	-18.5	-18.5	0.11 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00V/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.05')
CALCULATED VERT. DEFL.(LL) = L/999 (0.07')
ALLOWABLE DEFL.(TL) = L/360 (1.05')
CALCULATED VERT. DEFL.(TL) = L/999 (0.13')

CSI: TC=0.59/1.00 (B-C:1), QC=0.37/1.00 (O-P:1), WB=0.41/1.00 (H-K:1), SS=0.23/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BENO=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	818	354	1667	788	1587

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP=0.90 (E) (INPUT=0.90)
JSI METAL=0.49 (I) (INPUT=1.00)



Structural component only
DWG# T-2008039

JOB NAME 408316	TRUSS NAME T41	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:05:32 2020 Page 1					

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:05:32 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-mKloUTxyl_vPvMlxjo_xWbWaPbKkgJISIZmAzLa9H

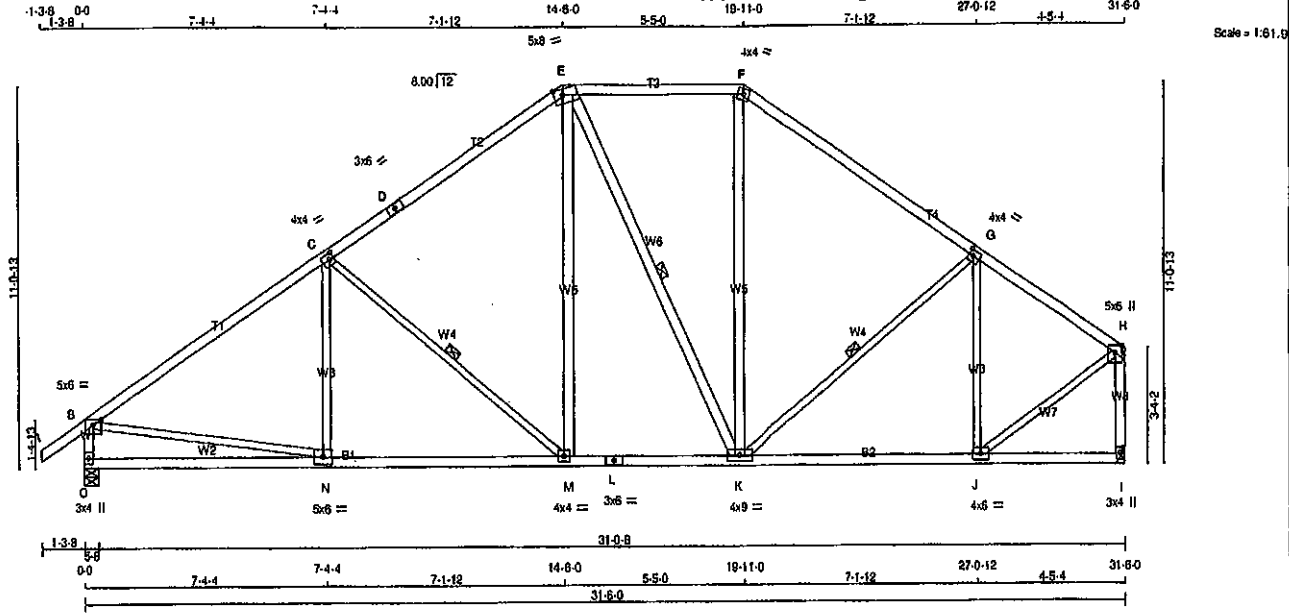

TOTAL WEIGHT = 155 lb
(M/F)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
O - B	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
O - L	2x4	DRY	No.2	SPF	
L - I	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
M - E	2x4	DRY	No.2	SPF	
E - K	2x4	DRY	No.2	SPF	
K - F	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge	
C	TMVW-i	MT20	4.0	4.0	2.00	1.50
D	TS-i	MT20	3.0	6.0		
E	TTWW-m	MT20	5.0	8.0	2.00	3.00
F	TTW-m	MT20	4.0	4.0		
G	TMVW-i	MT20	4.0	4.0	2.00	1.50
H	TMVW-p	MT20	5.0	6.0	Edge	
I	BMV1-p	MT20	3.0	4.0		
J	BMVW-i	MT20	4.0	6.0		
K	BMVW-i	MT20	4.0	9.0		
L	BS-i	MT20	3.0	6.0		
M	BMVW-i	MT20	4.0	4.0		
N	BMVW-i	MT20	5.0	6.0		
O	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UP
O	1862	0	1862	0
I	1736	0	1736	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I MINIMUM BEARING LENGTH AT JOINT I = 3'-8".

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
O	1315	878 / 0	0 / 0	0 / 0	0 / 0	439 / 0	0 / 0	0 / 0
I	1228	808 / 0	0 / 0	0 / 0	0 / 0	422 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-M, E-K, G-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO				FR-TO			
A-B	0 / 35	-91.8	-91.8 0.12 (1)	N-C	-102 / 89	10.00	0.07 (1)
B-C	-2080 / 0	-91.8	-91.8 0.83 (1)	C-M	-834 / 0	3.72	0.40 (1)
C-D	-1583 / 0	-91.8	-91.8 0.73 (1)	M-E	0 / 508	4.28	0.08 (1)
D-E	-1583 / 0	-91.8	-91.8 0.73 (1)	E-K	-176 / 0	4.28	0.14 (1)
E-F	-1181 / 0	-91.8	-91.8 0.37 (1)	K-F	0 / 279	5.41	0.04 (1)
F-G	-1462 / 0	-91.8	-91.8 0.64 (1)	G-K	-5 / 7	4.60	0.00 (1)
G-H	-1376 / 0	-91.8	-91.8 0.49 (1)	J-G	-889 / 0	4.91	0.44 (1)
O-B	-1807 / 0	0.0	0.0 0.19 (1)	B-N	0 / 1770	6.22	0.40 (1)
I-H	-1710 / 0	0.0	0.0 0.32 (1)	J-H	0 / 1441	6.36	0.32 (1)
O-N	0 / 0	-18.5	-18.5 0.25 (4)				
N-M	0 / 1751	-18.5	-18.5 0.41 (1)				
M-L	0 / 1288	-18.5	-18.5 0.29 (1)				
L-K	0 / 1288	-18.5	-18.5 0.29 (1)				
K-J	0 / 1191	-18.5	-18.5 0.28 (1)				
J-I	0 / 0	-18.5	-18.5 0.16 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD = 39.0 PSF				

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.05')
CALCULATED VERT. DEFL.(LL) = L/989 (0.07')
ALLOWABLE DEFL.(TL) = L/360 (1.05')
CALCULATED VERT. DEFL.(TL) = L/989 (0.16')

CSK: TC=0.83/1.00 (B-C:1), BC=0.41/1.00 (M-N:1), WB=0.44/1.00 (G-J:1), SS=0.27/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 384 1887 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (B) (INPUT = 0.90)
JSI METAL= 0.55 (H) (INPUT = 1.00)



Structural component only
DWG# T-2008040

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T42	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version B.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:05:33 2020 Page 1					
ID:DMCubINVR6Ts1Foe31v6l_zns1l-EWJAhoyas12GWVH7GVVA3o2uN7bqPh8bzDT6ldzLa9G					
Scale = 1:30.5					

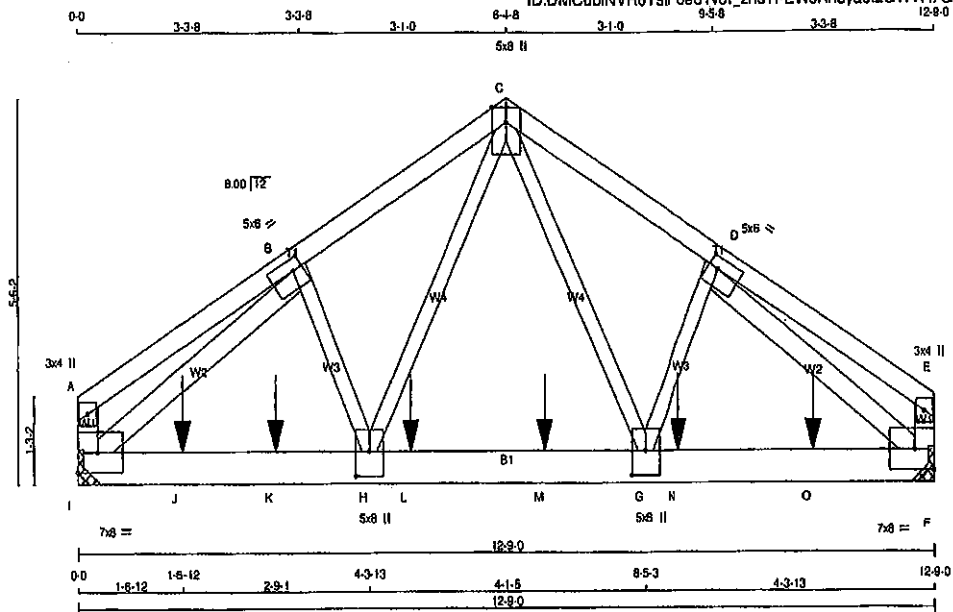

TOTAL WEIGHT = 2 X 64 = 128 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	No.2	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - E	2x4	DRY	No.2	SPF		
I - A	2x4	DRY	No.2	SPF		
F - E	2x4	DRY	No.2	SPF		
I - F	2x6	DRY	1650F 1.5E	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						
I - B	2x4	DRY	No.2	SPF		
O - F	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	12	TOP
C-E	12	TOP
I-A	12	TOP
F-E	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
I-F	12	SIDE (0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	
2x4	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
I	6128	0	6128	0
F	5588	0	5588	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I, F. MINIMUM BEARING LENGTH AT JOINT I = 4-0, JOINT F = 4-0.

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW
I	4327	2870 / 0
F	3947	2618 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.70 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	UNBRAC	MEMB.	MAX. FACTORED	MAX
MEMB.	FORCE (LBS)	FORCE (LBS)	PLF	CSI (LC)	UNBRAC	LENGTH	FR-TO	FORCE (LBS)	CSI (LC)	
FR-TO		FROM TO								
A-B	3 / 1	-91.8	-91.8	0.08 (1)	10.00	C-D	0 / 3327	0.41 (1)		
B-C	-6383 / 0	-91.8	-91.8	0.24 (1)	3.70	G-D	0 / 857	0.11 (1)		
C-D	-6154 / 0	-91.8	-91.8	0.22 (1)	3.78	H-C	0 / 3862	0.48 (1)		
D-E	-2 / 3	-91.8	-91.8	0.08 (1)	10.00	B-H	0 / 903	0.11 (1)		
I-A	-142 / 0	0.0	0.0	0.01 (1)	7.81	I-B	-6839 / 0	0.76 (1)		
F-E	-139 / 0	0.0	0.0	0.01 (1)	7.81	D-F	-6588 / 0	0.73 (1)		
I-J	0 / 4984	-18.5	-18.5	0.71 (1)	10.00					
J-K	0 / 4984	-18.5	-18.5	0.71 (1)	10.00					
K-H	0 / 4984	-18.5	-18.5	0.71 (1)	10.00					
H-L	0 / 3876	-18.5	-18.5	0.58 (1)	10.00					
L-M	0 / 3876	-18.5	-18.5	0.58 (1)	10.00					
M-G	0 / 3876	-18.5	-18.5	0.58 (1)	10.00					
G-N	0 / 4802	-18.5	-18.5	0.62 (1)	10.00					
N-O	0 / 4802	-18.5	-18.5	0.62 (1)	10.00					
O-F	0 / 4802	-18.5	-18.5	0.62 (1)	10.00					

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
J	1-6-12	-1718	-1718	---	FRONT	VERT	TOTAL	---	C1
K	2-11-4	-1718	-1718	---	FRONT	VERT	TOTAL	---	C1
L	4-11-4	-1718	-1718	---	FRONT	VERT	TOTAL	---	C1
M	6-11-4	-1718	-1718	---	FRONT	VERT	TOTAL	---	C1
N	8-11-4	-1718	-1718	---	FRONT	VERT	TOTAL	---	C1
O	10-11-4	-1718	-1718	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.43")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.43")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.24/1.00 (B-C:1), BC=0.71/1.00 (H-I:1), WB=0.78/1.00 (B-I:1), SSI=0.88/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (OR)	SHEAR	SECTION
(PS)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1887
	788	1987	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (B) (INPUT = 0.90)
JSI METAL = 0.82 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008041 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T42	1	2	GREEN PARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington


Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:05:33 2020 Page 2

ID:DMCubINVR6TsFoe31v6I zns1f-EWJAhoysae12GWVH7GVVA3o2uN7bqPh8bzDT6ldzLa9G

PLATES (table in inches)


JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B	TMWW-l	MT20	5.0	8.0	2.00	1.75
C	TTWW+p	MT20	5.0	8.0	Edge	
D	TMWW-l	MT20	5.0	8.0	2.00	1.75
E	TMV+p	MT20	3.0	4.0		
F	BMVW1-l	MT20	7.0	8.0	Edge	
G	BMVW+l	MT20	5.0	8.0	4.25	2.50
H	BMVW+l	MT20	5.0	8.0	4.25	2.50
I	BMVW1-l	MT20	7.0	8.0	Edge	

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

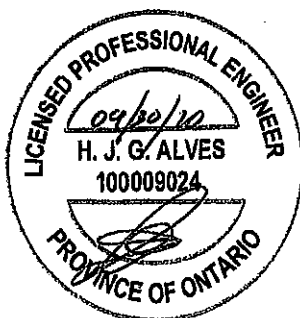

Structural component only
DWG# T-2008041 3/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T43S	1	1	GREEN PARK HOMES	
Temarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:05:34 2020 Page 1	

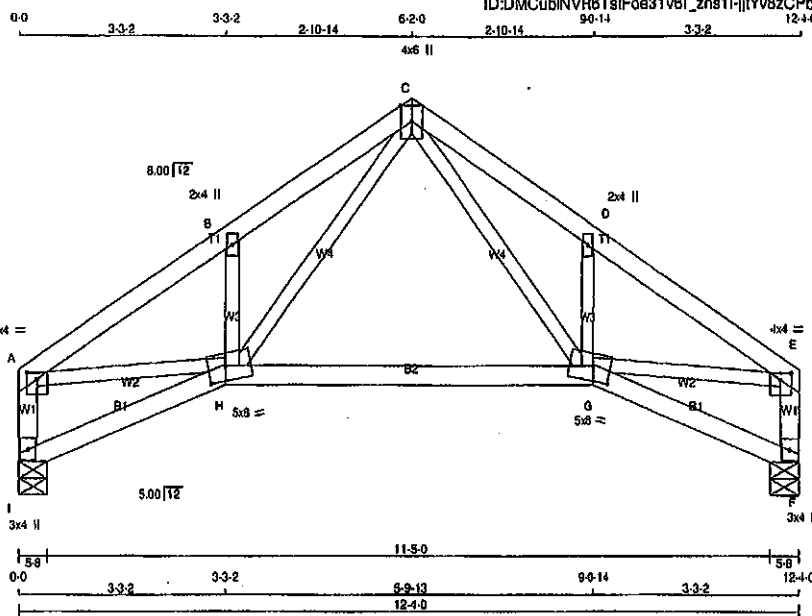

Scale: 3/8"=1'

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
I - A	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
H - G	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
A - C	MT20	4.0	4.0	1.25	2.00
B	MT20	2.0	4.0		
C	TTWW+p	4.0	6.0	Edge	
D	MTW+w	2.0	4.0		
E	MTW+p	4.0	4.0	1.25	2.00
F	BMV1+p	3.0	4.0		
G	BBWWW-m	5.0	6.0	2.75	3.25
H	BBWWW-m	5.0	6.0	2.75	3.25
I	BMV1+p	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
I	VERT 680	DOWN 0	0	5-8
F	HORZ 680	UP 0	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	COMBINED	316/0	0/0	0/0	0/0	165/0	0/0
F		316/0	0/0	0/0	0/0	165/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.13 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED HORIZ. LOAD (LC2)	WEBS	MAX. FACTORED MEMB. FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC1)
PR-TO		FROM	TO	LENGTH	FR-TO		
A-B	-973/0	-91.8	-91.8	0.12 (1)	C-G	0/551	0.12 (1)
B-C	-1008/0	-91.8	-91.8	0.10 (1)	G-D	-339/0	0.05 (1)
C-D	-1008/0	-91.8	-91.8	0.10 (1)	H-C	0/551	0.12 (1)
D-E	-973/0	-91.8	-91.8	0.12 (1)	H-B	-339/0	0.05 (1)
I-A	-850/0	0.0	0.0	0.07 (1)	A-H	0/822	0.18 (1)
F-E	-850/0	0.0	0.0	0.07 (1)	G-E	0/822	0.18 (1)
I-H	0/0	-18.5	-18.5	0.06 (4)			
H-G	0/502	-18.5	-18.5	0.22 (4)			
G-F	0/0	-18.5	-18.5	0.06 (4)			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.41")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.41")
CALCULATED VERT. DEFL.(TL) = L/999 (0.09")

CSI: TC=0.12/1.00 (A-B:1), BC=0.22/1.00 (G-H:4),
WB=0.18/1.00 (A-H:1), SS=0.11/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (A) (INPUT = 0.90)
JSI METAL= 0.28 (A) (INPUT = 1.00)




Structural component only
DWG# T-2008042

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408316	T43SX	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 2019 MTek Industries, Inc. Thu Apr 30 10:05:34 2020 Page 1
ID:DMCubiNVR6TstFoe31v8l_zns11-jlYv8zCPbA78fsKqC0Pc0b4eP3i8G7kCtCgq3zLa9F

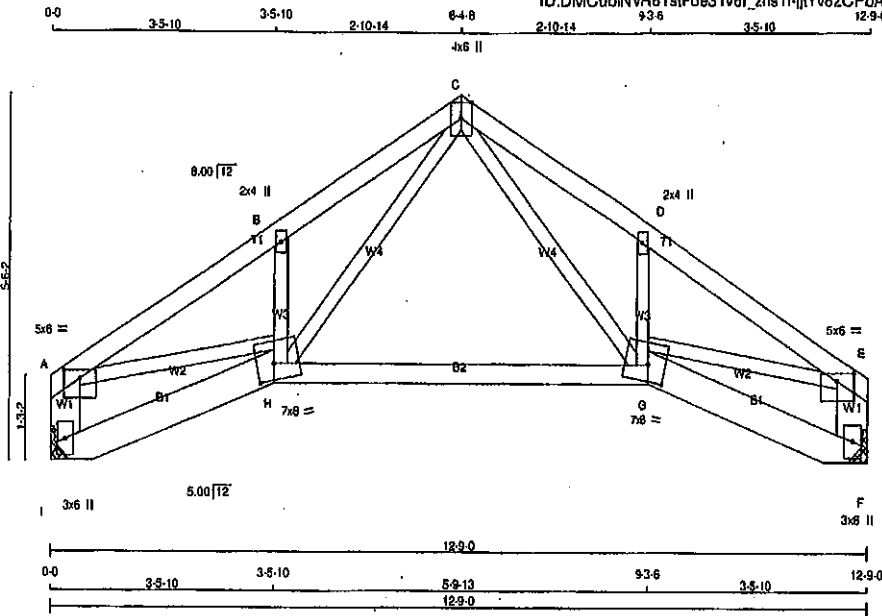

Scale: 3/8"=1'

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - E	2x4	DRY	No.2	SPF		
I - A	2x6	DRY	No.2	SPF		
F - E	2x6	DRY	No.2	SPF		
I - H	2x6	DRY	No.2	SPF		
H - G	2x4	DRY	No.2	SPF		
G - F	2x6	DRY	No.2	SPF		
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMW+p	MT20	5.0	6.0	1.50	3.00
B	TMW+w	MT20	2.0	4.0		
C	TMW+p	MT20	4.0	6.0	Edge	
D	TMW+w	MT20	2.0	4.0		
E	TMW+p	MT20	5.0	6.0	1.50	3.00
F	BMV1+p	MT20	3.0	6.0		
G	BBWW+m	MT20	7.0	8.0	3.00	3.25
H	BBWW+m	MT20	7.0	8.0	3.00	3.25
I	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	DOWN	HORZ	UPLIFT
I	703	0	0	0
F	703	0	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I, F. MINIMUM BEARING LENGTH AT JOINT I = 3-8, JOINT F = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
I	497	328.0	0.0	0.0	0.0	171.0	0.0
F	497	328.0	0.0	0.0	0.0	171.0	0.0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.89 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO				FR-TO			
A-B	-1084.0	-91.8	-91.8 0.14 (1)	5.92	C-G	0.631	0.14 (1)
B-C	-1119.0	-91.8	-91.8 0.11 (1)	5.89	G-D	-351.0	0.06 (1)
C-D	-1119.0	-91.8	-91.8 0.11 (1)	5.89	H-C	0.631	0.14 (1)
D-E	-1084.0	-91.8	-91.8 0.14 (1)	5.92	H-B	-351.0	0.06 (1)
I-A	-671.0	0.0	0.0 0.04 (1)	7.81	A-H	0.616	0.21 (1)
F-E	-671.0	0.0	0.0 0.04 (1)	7.81	G-E	0.616	0.21 (1)
I-H	0.0	-18.5	-18.5 0.03 (4)	10.00			
H-G	0.544	-18.5	-18.5 0.23 (4)	10.00			
G-F	0.0	-18.5	-18.5 0.03 (4)	10.00			

TOTAL WEIGHT = 57.0

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6 PSF
DL	= 6.0 PSF	
BOT CH.	LL	= 0.0 PSF
DL	= 7.4 PSF	
TOTAL LOAD	= 39.0 PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.43")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.43")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.10")

CSI: TC=0.14/1.00 (A-B:1), BC=0.23/1.00 (G-H:4), WB=0.21/1.00 (A-H:1), SS=0.12/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX	MIN	MAX
MIN	MAX	MIN
MT20	618	354
	1667	788
	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.50 (E) (INPUT = 0.90)
JSI METAL= 0.22 (E) (INPUT = 1.00)



Structural component only
DWG# T-2008043

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:05:35 2020 Page 1

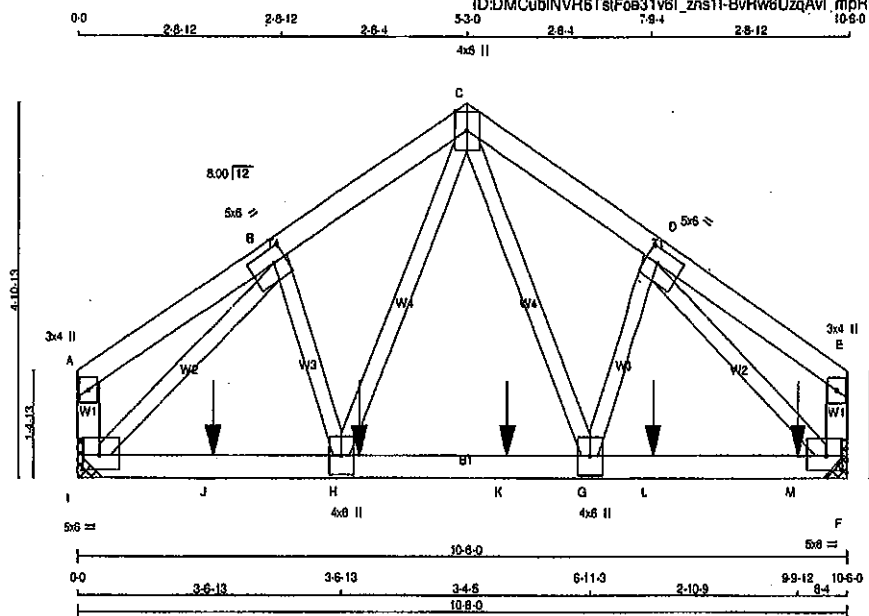

TOTAL WEIGHT = 2 X 47 = 93 lb

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT
SEPARATELY THEN FASTENED TOGETHER AS
FOLLOWS:


NAILS TO BE DRIVEN FROM ONE SIDE ONLY

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMW-p	MT20	3.0	4.0	
B	TMWV-t	MT20	5.0	6.0	2.25 2.00

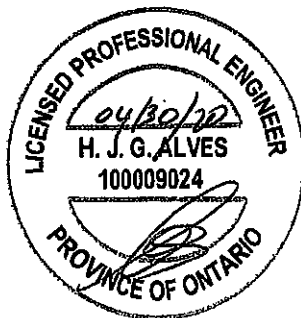

Structural component only
DWG# T-2008044 1/2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQD
		GROSS REACTION		GROSS REACTION		BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
I	4453	0	4453	0	0	MECHANICAL	
F	5297	0	5297	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. F. MINIMUM BEARING LENGTH AT JOINT I = 4'-0". JOINT F = 4'-0".

UNFACTORED REACTIONS

1ST LOASE		MAX MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	3145	2088/0	0/0	0/0	0/0	1059.0	0/0
F	3742	2481/0	0/0	0/0	0/0	1261.0	0/0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.45 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)		
FR-TO		FROM TO			FR-TO				
A-B	-570	-91.8	-91.8	0.07 (1)	10.00	C-G	0 / 2469 0.31 (1)		
B-C	-4431 / 0	-91.8	-91.8	0.14 (1)	4.45	G-D	0 / 1006 0.12 (1)		
C-D	-4422 / 0	-91.8	-91.8	0.14 (1)	4.45	H-C	0 / 2491 0.31 (1)		
D-E	-570	-91.8	-91.8	0.07 (1)	10.00	B-H	0 / 1009 0.12 (1)		
I-A	-128 / 0	0.0	0.0	0.01 (1)	7.81	I-B	-4953 / 0 0.65 (1)		
F-E	-127 / 0	0.0	0.0	0.01 (1)	7.81	D-F	-4943 / 0 0.65 (1)		
I-J	0 / 3361	-18.5	-18.5	0.74 (1)	10.00				
J-H	0 / 3361	-18.5	-18.5	0.74 (1)	10.00				
H-K	0 / 2833	-18.5	-18.6	0.66 (1)	10.00				
K-G	0 / 2833	-18.5	-18.5	0.66 (1)	10.00				
G-L	0 / 3354	-18.5	-18.5	0.68 (1)	10.00				
L-M	0 / 3354	-18.5	-18.5	0.68 (1)	10.00				
M-F	0 / 3354	-18.5	-18.5	0.68 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN
H	3-9-12	-1718	-1718	---	FRONT	VERT	TOTAL	--	C1
J	1-9-12	-1718	-1718	---	FRONT	VERT	TOTAL	--	C1
K	5-9-12	-1718	-1718	---	FRONT	VERT	TOTAL	--	C1
L	7-9-12	-1718	-1718	---	FRONT	VERT	TOTAL	--	C1
M	9-9-12	-1721	-1721	---	FRONT	VERT	TOTAL	--	G1

CONNECTION REQUIREMENTS

1) Cf: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:				
TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD				= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BOBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2018 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (0.35")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.06")
ALLOWABLE DEFL.(TL) = 1/360 (0.35")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.12")

CSI: TC=0.14/1.00 (B-C:1), 8C=0.74/1.00 (H-I:1),
WB=0.65/1.00 (B-I:1), SSI=0.84/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
-------	--------------------	----------------	------------------

	(FSI)		(FLI)		(FLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1887	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg

JSI GRIP= 0.90 (D) (INPUT = 0.90)
JSI METAL= 0.57 (B) (INPUT = 1.00)

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T44	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:05:35 2020 Page 2
ID:DMCubjNVR6TslF0e31v6l z0a1l-BvRw6UzgAvl mcRWOWYe8D7FS0GwicMuRxyDMVzLa9E

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
C	TTWW+p	MT20	4.0	6.0	Edge	
D	TMWW-l	MT20	5.0	6.0	2.25	2.00
E	TMV+p	MT20	3.0	4.0		
F	BMVW1-t	MT20	5.0	6.0	2.25	2.75
G	BMVW1-t	MT20	4.0	6.0		
H	BMVW1-t	MT20	4.0	6.0		
I	BMVW1-t	MT20	5.0	6.0	2.25	2.75

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.




Structural component only
DWG# T-2008044 *ye*

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408316	T45	1	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Thu Apr 30 10:05:36 2020 Page 1
ID:DMCubINVR8TslFoe31v6l_zns11-157IKq_SxDQrNz7iyd3lthRgNFCIRcCU1l8hmvzLa9D

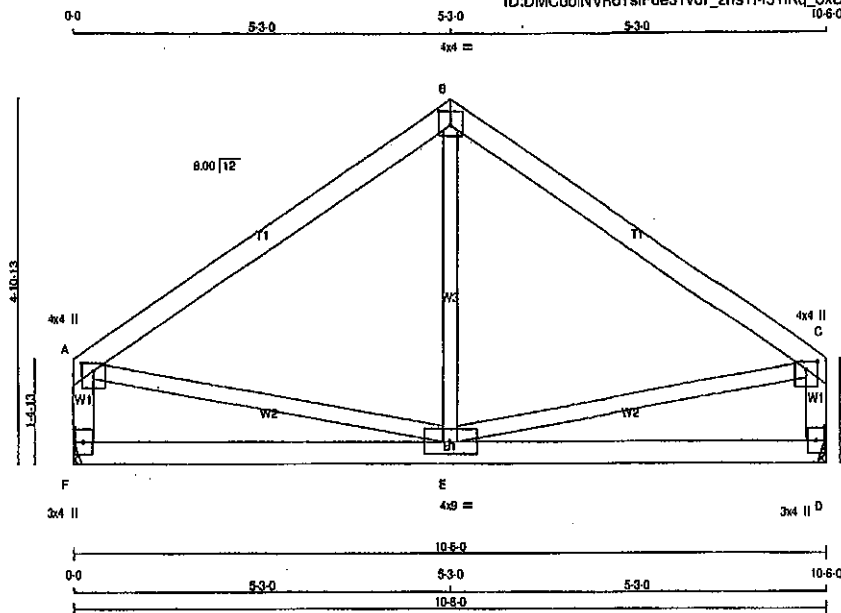

Scale = 1:20.0

TOTAL WEIGHT = 41 lb

LUMBER	N. L. C. A. RULES	CHORDS	SIZE	LUMBER
A - B	2x4 DRY	No.2		
B - C	2x4 DRY	No.2		
F - A	2x4 DRY	No.2		
D - C	2x4 DRY	No.2		
F - D	2x4 DRY	No.2		

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TTW-p	MT20	4.0	4.0	2.25	2.00
C	TMVW+p	MT20	4.0	4.0	1.25	2.00
D	BMV1+p	MT20	3.0	4.0		
E	BMVWW-t	MT20	4.0	9.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	579	0	579	0
D	579	0	579	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D. MINIMUM BEARING LENGTH AT JOINT F = 1-8, JOINT D = 1-8.

UNFACTORED REACTIONS

MAX. MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	409	269 / 0	0 / 0	0 / 0	0 / 0	141 / 0	0 / 0
D	409	269 / 0	0 / 0	0 / 0	0 / 0	141 - 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. (PLF)	CS1 (LC)	UNBRAC	FR-TO	FR-TO	FORCE (LBS)	MAX (LC)
A-B	-414 / 0	-91.8	-91.8	0.33 (1)	6.25	E-B	-22 / 82	0.03 (4)
B-C	-414 / 0	-91.8	-91.8	0.33 (1)	6.25	A-E	0 / 352	0.08 (1)
F-A	-541 / 0	0.0	0.0	0.08 (1)	7.81	E-C	0 / 352	0.08 (1)
D-C	-541 / 0	0.0	0.0	0.08 (1)	7.81			
F-E	0 / 0	-18.5	-18.5	0.14 (4)	10.00			
E-D	0 / 0	-18.5	-18.5	0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

OSI: TC=0.33/1.00 (B-C:1), BC=0.14/1.00 (E-F:4), WB=0.09/1.00 (A-E:1), SSI=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.43 (C) (INPUT = 0.30)
JSI METAL= 0.13 (C) (INPUT = 1.00)



Structural component only
DWG# T-2008045

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	T45S	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 10:05:34 2020 Page 1		ID:DMCubINVR6TslFoe31v6l_zns11-f5?Kq_SxDQrNz?yjd3HrRgRCmpc8Q1fBhmvyzLa9D	
		Scale = 1:20.1			

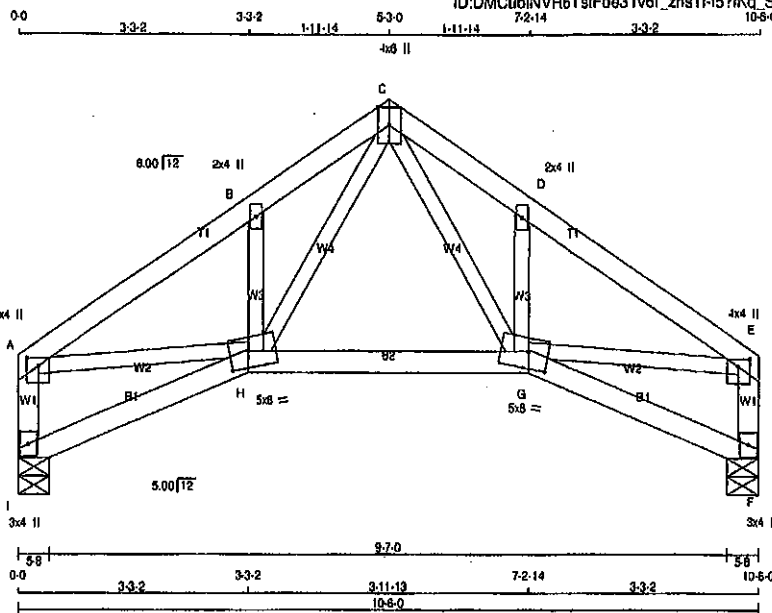

LUMBER			
N.L.G.A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4 DRY	No.2	SPF
C - E	2x4 DRY	No.2	SPF
I - A	2x4 DRY	No.2	SPF
F - E	2x4 DRY	No.2	SPF
I - H	2x4 DRY	No.2	SPF
H - G	2x4 DRY	No.2	SPF
G - F	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
A - C	MT20	4.0	4.0	1.25	2.00
B	MT20	2.0	4.0		
C	MT20	4.0	6.0	Edge	
D	MT20	2.0	4.0		
E	MT20	4.0	4.0	1.25	2.00
F	MT20	3.0	4.0		
G	MT20	5.0	8.0	2.75	3.25
H	MT20	5.0	8.0	2.75	3.25
I	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
I	579	0	579	0
F	579	0	579	0

UNFACTORED REACTIONS

1ST LOSE	MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	409	289 / 0	0 / 0	0 / 0	0 / 0	141 / 0	0 / 0
F	409	289 / 0	0 / 0	0 / 0	0 / 0	141 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (L)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (L)	
FR-TO		FROM TO		FR-TO			
A-B	-778 / 0	-91.8 -91.8	0.12 (1)	C-G	0 / 448	0.10 (1)	
B-C	-813 / 0	-91.8 -91.8	0.08 (1)	G-D	-299 / 0	0.05 (1)	
C-D	-813 / 0	-91.8 -91.8	0.08 (1)	H-C	0 / 448	0.10 (1)	
D-E	-778 / 0	-91.8 -91.8	0.12 (1)	H-B	-299 / 0	0.05 (1)	
I-A	-549 / 0	0.0 0.0	0.06 (1)	A-H	0 / 657	0.15 (1)	
F-E	-549 / 0	0.0 0.0	0.06 (1)	G-E	0 / 657	0.15 (1)	
I-H	0 / 0	-18.5 -18.5	0.06 (4)				
H-G	0 / 435	-18.5 -18.5	0.12 (4)				
G-F	0 / 0	-18.5 -18.5	0.06 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2018 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.35")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.35")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.12/1.00 (D-E:1), BC=0.12/1.00 (G-H:4), WB=0.15/1.00 (A-H:1), SSI=0.11/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.85 (A) (INPUT = 0.60)
JSI METAL = 0.20 (A) (INPUT = 1.00)



Structural component only
DWG# T-2008046


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408317	T50	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 M/Tek Industries, Inc. Thu Apr 30 10:50:31 2020 Page 1

ID:DMCubINVR6TslFoe31v6l_zns1l-Fal7yLbxGFySC7XgK7vsPlopaSwYy8jNz017EzL ZV6

1-3-8 0-0 5-10-8 5-10-8 5-10-10 11-9-2 5-9-6 17-8-8 5-9-6 5-10-10 5-10-8 5-10-8 33-1-0 38-4-8 1-3-8 Scale = 1:57.5

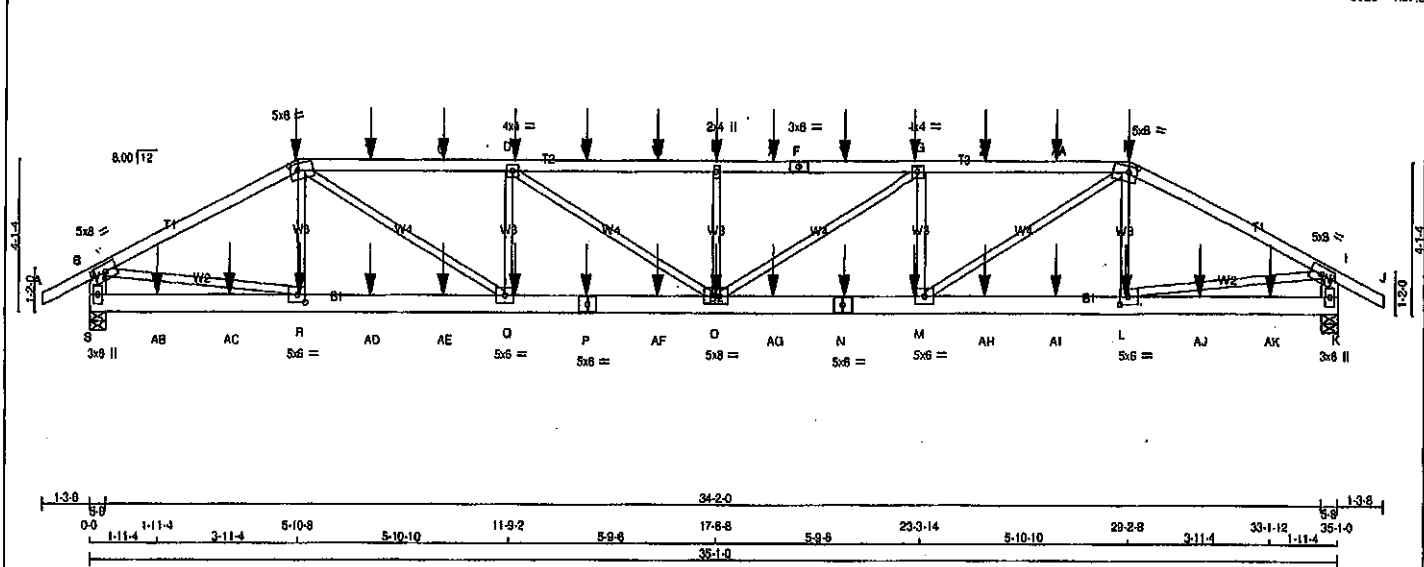

TOTAL WEIGHT = 2 X 154 = 308 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - F	2x4	DRY	No.2	SPF		
F - H	2x4	DRY	No.2	SPF		
H - J	2x4	DRY	No.2	SPF		
S - B	2x6	DRY	No.2	SPF		
K - I	2x6	DRY	No.2	SPF		
S - P	2x6	DRY	No.2	SPF		
P - N	2x6	DRY	No.2	SPF		
N - K	2x6	DRY	No.2	SPF		
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF		

DRY: SEASONED LUMBER.
DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-G 1	12	SIDE(81.0)
C-F 1	12	SIDE(81.0)
F-H 1	12	SIDE(81.0)
H-J 1	12	SIDE(81.0)
S-B 2	12	TOP
K-I 2	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
S-P 2	12	SIDE(183.1)
P-N 2	12	SIDE(183.1)
N-K 2	12	SIDE(183.1)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.
TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.



Structural component only
DWG# T-2008054

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT VERT	3303	DOWN	3303	0	0	5-8	5-8
S	3303	0	3303	0	0	5-8	5-8
K	3303	0	3303	0	0	5-8	5-8

UNFACTORED REACTIONS		MAX/MIN COMPONENT REACTIONS	
1ST LOOSE			
JT COMBINED	1528 / 0	LIVE	0 / 0
S	2336	PERM.LIVE	0 / 0
K	2336	WIND	0 / 0
		DEAD	808.0
		SOIL	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.89 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO				FR-TO			
A-B	0 / 28	-81.8	-81.8 0.07 (1)	10.00	R-C	-377 / 33	0.05 (1)
B-C	-5023 / 0	-81.8	-81.8 0.52 (1)	3.89	C-D	0 / 3072	0.38 (1)
C-T	-7076 / 0	-81.8	-81.8 0.74 (1)	3.11	D-Q	-1459 / 0	0.19 (1)
T-U	-7076 / 0	-81.8	-81.8 0.74 (1)	3.11	Q-O	0 / 916	0.11 (1)
U-D	-7076 / 0	-81.8	-81.8 0.74 (1)	3.11	O-E	-821 / 0	0.10 (1)
D-V	-7846 / 0	-81.8	-81.8 0.80 (1)	2.89	O-G	0 / 916	0.11 (1)
V-W	-7846 / 0	-81.8	-81.8 0.80 (1)	2.89	M-G	-1459 / 0	0.19 (1)
W-E	-7846 / 0	-81.8	-81.8 0.80 (1)	2.89	M-H	0 / 3072	0.38 (1)
E-X	-7846 / 0	-81.8	-81.8 0.80 (1)	2.89	L-H	-378 / 33	0.05 (1)
X-F	-7846 / 0	-81.8	-81.8 0.80 (1)	2.89	R-R	0 / 4528	0.58 (1)
F-Y	-7846 / 0	-81.8	-81.8 0.80 (1)	2.89	L-I	0 / 4528	0.58 (1)
Y-G	-7846 / 0	-81.8	-81.8 0.80 (1)	2.89			
G-Z	-7076 / 0	-81.8	-81.8 0.74 (1)	3.11			
Z-AA	-7076 / 0	-81.8	-81.8 0.74 (1)	3.11			
AA-H	-7076 / 0	-81.8	-81.8 0.74 (1)	3.11			
H-I	-5023 / 0	-81.8	-81.8 0.52 (1)	3.89			
I-J	0 / 28	-81.8	-81.8 0.07 (1)	10.00			
S-B	-3228 / 0	0.0	0.0 0.11 (1)	7.71			
K-I	-3227 / 0	0.0	0.0 0.11 (1)	7.71			

S-AB	0 / 0	-18.5	-18.5 0.08 (4)	10.00
AB-AC	0 / 0	-18.5	-18.5 0.08 (4)	10.00
AC-R	0 / 0	-18.5	-18.5 0.08 (4)	10.00
R-AD	0 / 4480	-18.5	-18.5 0.34 (1)	10.00
AD-AE	0 / 4480	-18.5	-18.5 0.34 (1)	10.00
AE-O	0 / 4480	-18.5	-18.5 0.34 (1)	10.00
Q-P	0 / 7076	-18.5	-18.5 0.53 (1)	10.00
P-AF	0 / 7076	-18.5	-18.5 0.53 (1)	10.00
AF-O	0 / 7076	-18.5	-18.5 0.53 (1)	10.00
O-AG	0 / 7076	-18.5	-18.5 0.53 (1)	10.00
AG-N	0 / 7076	-18.5	-18.5 0.53 (1)	10.00
N-M	0 / 7076	-18.5	-18.5 0.53 (1)	10.00
M-AH	0 / 4480	-18.5	-18.5 0.34 (1)	10.00
AH-AI	0 / 4480	-18.5	-18.5 0.34 (1)	10.00
AI-L	0 / 4480	-18.5	-18.5 0.34 (1)	10.00
L-AJ	0 / 0	-18.5	-18.5 0.08 (4)	10.00
AJ-AK	0 / 0	-18.5	-18.5 0.08 (4)	10.00
AK-K	0 / 0	-18.5	-18.5 0.08 (4)	10.00

FACTORED CONCENTRATED LOADS (LBS)		FACE		DIR.		TYPE		HEEL		CONN.	
JT	LOC.	LC1	MAX.	MAX.	FRONT	VERT	TOTAL	TOTAL	---	C1	C1
C	5-10-8	-414	-414	---	FRONT	VERT	TOTAL	TOTAL	---	C1	C1
D	11-11-4	-110	-110	---	FRONT	VERT	TOTAL	TOTAL	---	C1	C1

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = L/899 (0.25")
ALLOWABLE DEFL.(TL) = L/360 (1.17)
CALCULATED VERT. DEFL.(TL) = L/901 (0.47")

CSI: TC=0.80/1.00 (D-E:1), BC=0.53/1.00 (O-Q:1).

WB=0.56/1.00 (B-R:1), SS=0.20/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1937 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.90 (L) (INPUT=0.90)

JSI METAL=0.68 (P) (INPUT=1.00)

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	ORWG NO.
408317	T50	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:50:31 2020 Page 2

ID:DMCubINVR6TslFos31v6l zns11-FaL7yLbxGFySC7XqK7vsPloepaSwYy8iNz0l?EzLZV6

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	5.0	8.0		
C	TTWW-m	MT20	5.0	8.0	2.00	2.75
D	TMVW-1	MT20	4.0	4.0		
E	TMVW-w	MT20	2.0	4.0		
F	TS-1	MT20	3.0	6.0		
G	TMVW-1	MT20	4.0	4.0		
H	TTWW-m	MT20	5.0	8.0	2.00	2.75
I	TMVW-1	MT20	5.0	8.0		
K	BMV1-p	MT20	3.0	6.0		
L	BMVW-1	MT20	5.0	6.0	2.50	2.75
M	BMVW-1	MT20	5.0	6.0		
N	BS-1	MT20	5.0	6.0		
O	BMVW-1	MT20	5.0	6.0		
P	BS-1	MT20	5.0	6.0		
Q	BMVW-1	MT20	5.0	6.0		
R	BMVW-1	MT20	5.0	6.0	2.50	2.75
S	BMV1-p	MT20	3.0	6.0		

FACTORED CONCENTRATED LOADS (LBS)


JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	17-6-8	-110	-110	---	FRONT	VERT	TOTAL	---	C1
G	23-1-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
H	29-2-8	-414	-414	---	FRONT	VERT	TOTAL	---	C1
L	29-1-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
M	23-1-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
N	21-1-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
O	17-6-8	-28	-28	---	FRONT	VERT	TOTAL	---	C1
P	13-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
Q	11-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
R	5-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
T	7-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
U	9-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
V	13-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	15-11-4	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	19-1-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	21-1-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	25-1-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	27-1-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AB	1-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AC	3-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AD	7-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AE	9-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AF	15-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AG	19-1-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AH	25-1-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AI	27-1-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AJ	31-1-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
AK	33-1-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2008054

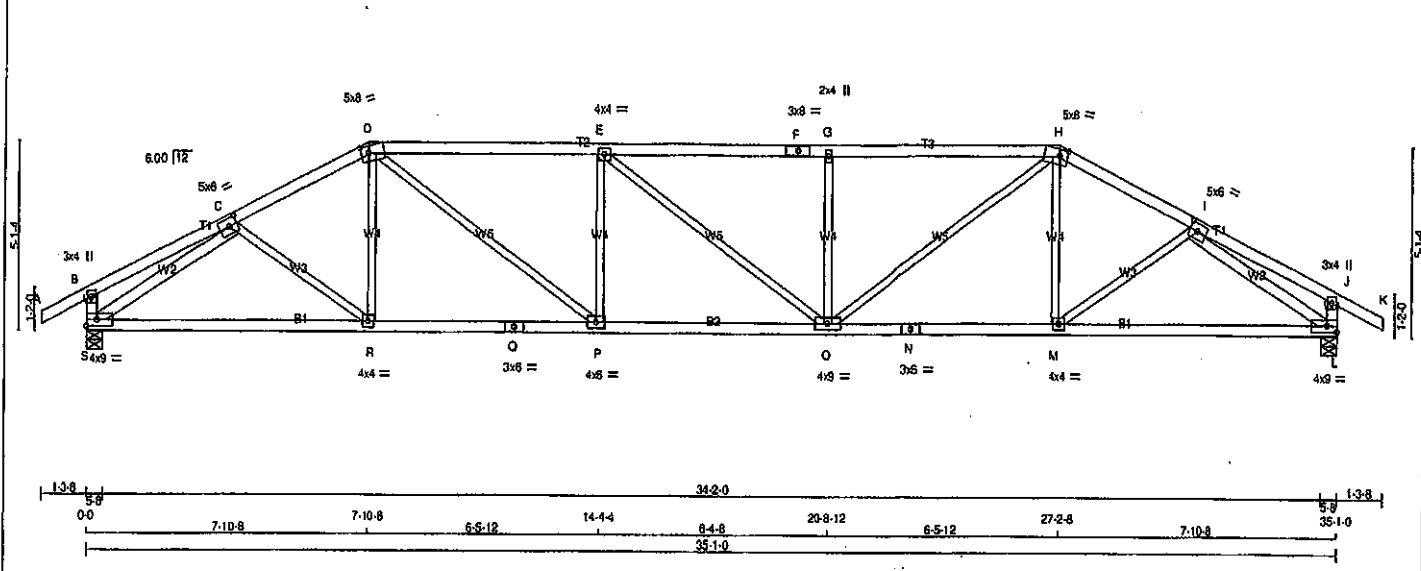

TOTAL WEIGHT = 139 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVAp	MT20	3.0	4.0		
C	TMVWv1	MT20	5.0	6.0	2.50	2.75
D	TTWWv1	MT20	5.0	6.0	2.25	2.75
E	TMVWv1	MT20	4.0	4.0		
F	TS-1	MT20	3.0	6.0		
G	TMVWv1	MT20	2.0	4.0		
H	TTWWv1	MT20	5.0	6.0	2.25	2.75
I	TMVWv1	MT20	5.0	6.0	2.50	2.75
J	TMVAp	MT20	3.0	4.0		
L	BMVWv1	MT20	4.0	9.0		Edge
M	BMVWv1	MT20	4.0	4.0		
N	BS-1	MT20	3.0	6.0		
O	BMVWv1	MT20	4.0	9.0		
P	BMVWv1	MT20	4.0	6.0		
Q	BS-1	MT20	3.0	6.0		
R	BMVWv1	MT20	4.0	4.0		
S	BMVWv1	MT20	4.0	9.0		Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD			
	GROSS REACTION	GROSS REACTION	BRG	BRG			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
S	2059	0	2059	0	0	5-8	5-8
L	2059	0	2059	0	0	5-8	5-8

UNFACTORED REACTIONS

	1ST LCASE	MAX. MIN.	COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
S	1453	987 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	
L	1453	987 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L.

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.95 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRAC LENGTH	
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-91.8 -91.8 0.12 (1)	10.00	C-R	0 / 93	0.03 (4)	
B-C	0 / 18	-91.8 -91.8 0.20 (1)	10.00	R-D	0 / 121	0.04 (4)	
C-D	-2791 / 0	-91.8 -91.8 0.31 (1)	3.89	D-P	0 / 1258	0.28 (1)	
D-E	-3492 / 0	-91.8 -91.8 0.93 (1)	2.95	P-E	-541 / 0	0.25 (1)	
E-F	-3491 / 0	-91.8 -91.8 0.92 (1)	2.95	E-O	-2 / 0	0.00 (1)	
F-G	-3491 / 0	-91.8 -91.8 0.92 (1)	2.95	O-G	-540 / 0	0.25 (1)	
G-H	-3491 / 0	-91.8 -91.8 0.93 (1)	2.97	O-H	0 / 1256	0.28 (1)	
H-I	-2791 / 0	-91.8 -91.8 0.31 (1)	3.89	M-H	0 / 121	0.04 (4)	
I-J	0 / 18	-91.8 -91.8 0.20 (1)	10.00	M-I	0 / 83	0.03 (4)	
J-K	0 / 28	-91.8 -91.8 0.12 (1)	10.00	S-C	-2966 / 0	0.82 (1)	
S-B	-270 / 0	0.0 0.0 0.03 (1)	7.81	I-L	-2966 / 0	0.82 (1)	
L-J	-270 / 0	0.0 0.0 0.03 (1)	7.81				
S-R	0 / 2411	-18.5 -18.5 0.53 (1)	10.00				
R-Q	0 / 2481	-18.5 -18.5 0.54 (1)	10.00				
Q-P	0 / 2481	-18.5 -18.5 0.54 (1)	10.00				
P-O	0 / 3492	-18.5 -18.5 0.84 (1)	10.00				
O-N	0 / 2482	-18.5 -18.5 0.54 (1)	10.00				
N-M	0 / 2482	-18.5 -18.5 0.54 (1)	10.00				
M-L	0 / 2411	-18.5 -18.5 0.53 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/899 (0.21")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/899 (0.41")

CSI: TC=0.93/1.00 (D-E:1), BC=0.84/1.00 (O-P:1), WB=0.82/1.00 (H-I:1), SSI=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	616	354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (L) (INPUT = 0.90)
JSI METAL= 0.77 (IN) (INPUT = 1.00)

Structural component only
DWG# T-2008055



Tamarack Roof Truss, Burlington


Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 10:50:33 2020 Page 1

ID:DMCubiNVR6TstF0e31v6I_zns1I-BYsIMtdBnsDARRh2PYxKUAIt7kO9n0rJ0rHV_37zLVZ4V

1-3-6 0-0 5-0-8 9-10-8 17-8-8 25-2-8 30-0-8 35-1-0 38-4-8

1-3-8 5-0-8 11-10-0 7-8-0 7-0-0 11-0-0 13-8-8

Scale: 1/4" = 1'-0"

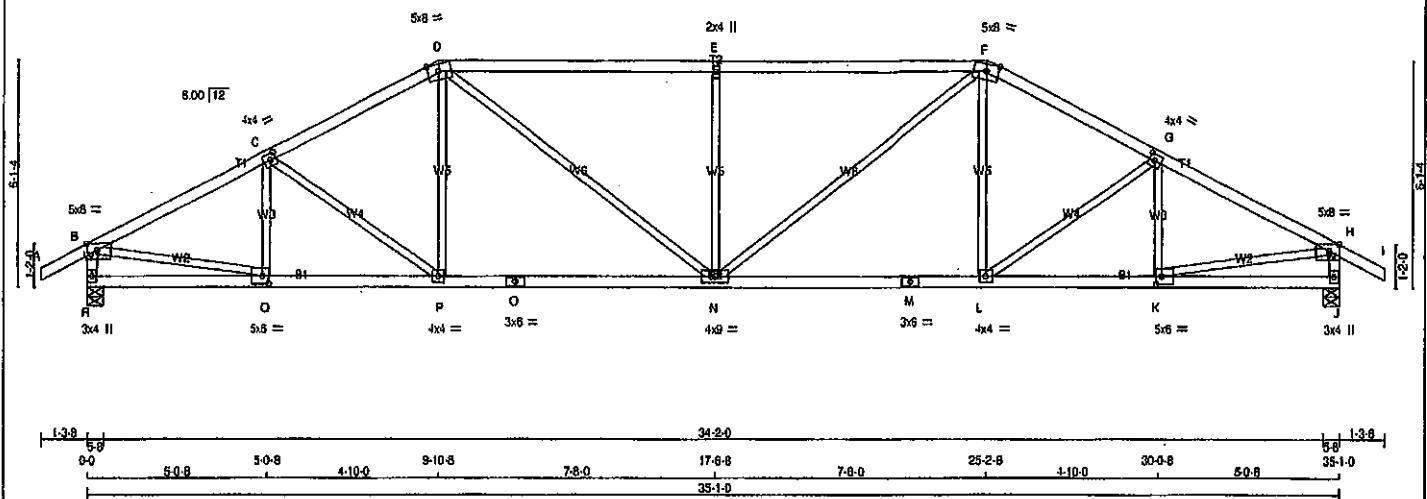

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
DRY: SEASONED LUMBER.

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

BUILDING DESIGNER BEARINGS

UNFACTORED REACTIONS

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B. I.

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.83 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM	TO	LENGTH	FR-TO			
A-B	0 / 20	-91.8	-91.8	0.12 (1)	10.00	C-Q	-352 / 0	0.08 (1)
B-C	-2826 / 0	-91.8	-91.8	0.39 (1)	3.81	C-P	-211 / 0	0.13 (1)
C-D	-2879 / 0	-91.8	-91.8	0.37 (1)	3.92	P-D	0 / 246	0.06 (4)
D-E	-3044 / 0	-91.8	-91.8	0.98 (1)	2.83	D-N	0 / 838	0.19 (1)
E-F	-3044 / 0	-91.8	-91.8	0.56 (1)	2.83	N-E	-867 / 0	0.51 (1)
F-G	-2879 / 0	-91.8	-91.8	0.37 (1)	3.92	N-F	0 / 838	0.19 (1)
G-H	-2826 / 0	-91.8	-91.8	0.39 (1)	3.81	L-F	0 / 246	0.06 (4)
H-I	0 / 28	-91.8	-91.8	0.12 (1)	10.00	L-G	-211 / 0	0.13 (1)
I-B	-2014 / 0	0.0	0.0	0.20 (1)	5.95	K-G	-352 / 0	0.08 (1)
J-H	-2014 / 0	0.0	0.0	0.20 (1)	5.95	B-Q	0 / 2584	0.58 (1)
						K-H	0 / 2584	0.58 (1)
R-Q	0 / 0	-18.5	-18.5	0.10 (4)	10.00			
Q-P	0 / 2548	-18.5	-18.5	0.50 (1)	10.00			
P-O	0 / 2378	-18.5	-18.5	0.49 (1)	10.00			
O-N	0 / 2378	-18.5	-18.5	0.49 (1)	10.00			
N-M	0 / 2378	-18.5	-18.5	0.49 (1)	10.00			
M-L	0 / 2378	-18.5	-18.5	0.49 (1)	10.00			
L-K	0 / 2548	-18.5	-18.5	0.50 (1)	10.00			
K-J	0 / 0	-18.5	-18.5	0.10 (4)	10.00			

SPECIFIED LOADS:			
TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD =		39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.17")
 CALCULATED VERT. DEFL.(LL) = $L/999$ (0.17")
 ALLOWABLE DEFL.(TL) = $L/360$ (1.17")
 CALCULATED VERT. DEFL.(TL) = $L/999$ (0.34")

CSI: TC=0.98/1.00 (D-E:1), BC=0.50/1.00 (P-Q:1),
WB=0.58/1.00 (B-Q:1), SS=0.34/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

	PLATE GRP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	818	354	1087	788	1987	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.88 (F) (INPUT = 0.90)
JSI METAL = 0.75 (O) (INPUT = 1.00)



Structural component only
DWG# T-2008056

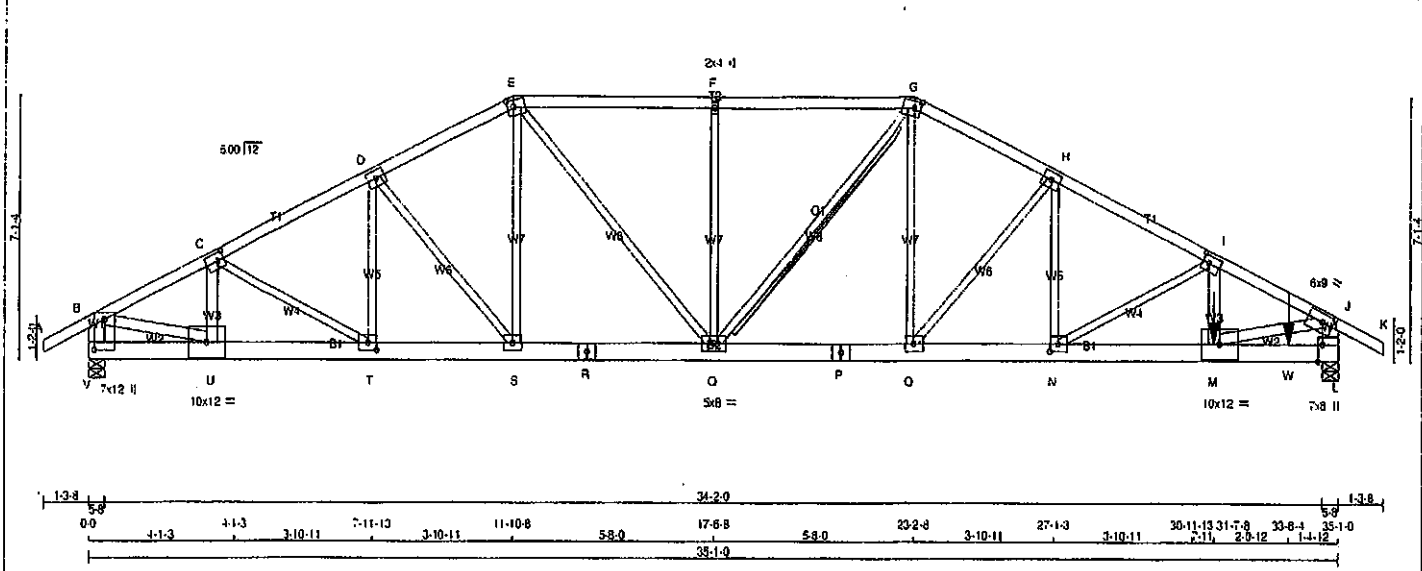

TOTAL WEIGHT = 2 X 17' - 354 lb

LUMBER	N. L. G. A. RULES	SIZE	DRY	LUMBER	DESCR.	SPF
A - E	2x4	DRY	No.2			SPF
E - G	2x4	DRY	No.2			SPF
G - K	2x4	DRY	No.2			SPF
V - B	2x6	DRY	No.2			SPF
L - J	2x6	DRY	No.2			SPF
V - R	2x6	DRY	No.2			SPF
R - P	2x6	DRY	No.2			SPF
P - L	2x6	DRY	No.2			SPF
ALL WEBS EXCEPT	2x3	DRY	No.2			SPF
U - C	2x4	DRY	No.2			SPF
M - I	2x4	DRY	No.2			SPF
S - U	2x4	DRY	No.2			SPF
M - J	2x4	DRY	No.2			SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-E 1	12	TOP
E-G 1	12	TOP
G-K 1	12	TOP
V-B 2	12	TOP
L-J 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
V-R 2	12	TOP
R-P 2	12	TOP
P-L 2	6	SIDE(427.3)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	SIDE(1083.7)
I-M 2	2	
2x4 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT VERT HORZ	DOWN HORZ	UPLIFT	IN-SX	IN-SX
V 2649 0	2649 0	0	5-8	5-8
L 7868 0	7868 0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LOSE	MAX. MIN. COMPONENT REACTIONS					
JT COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
V 1870 1245 0	0 0	0 0	0 0	0 0	626 0	0 0
L 5564 3702 0	0 0	0 0	0 0	0 0	1852 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.59 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT G-Q

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 8" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 28	-91.8 -91.8 0.07 (1)	10.00	U-C	-692 0	0.04 (1)	
B-C	-3600 0	-91.8 -91.8 0.14 (1)	4.84	C-T	0 326	0.04 (1)	
C-D	-3931 0	-91.8 -91.8 0.19 (1)	4.63	T-D	-82 33	0.02 (1)	
D-E	-3718 0	-91.8 -91.8 0.18 (1)	4.74	D-S	-331 0	0.11 (1)	
E-F	-4114 0	-91.8 -91.8 0.37 (1)	4.33	S-E	0 387	0.05 (1)	
F-G	-4114 0	-91.8 -91.8 0.37 (1)	4.33	O-G	0 2035	0.25 (1)	
G-H	-4803 0	-91.8 -91.8 0.23 (1)	4.21	O-H	-2534 0	0.86 (1)	
H-I	-6580 0	-91.8 -91.8 0.34 (1)	3.59	N-H	0 2276	0.28 (1)	
I-J	-10833 0	-91.8 -91.8 0.53 (1)	2.59	N-I	-4330 0	0.97 (1)	
J-K	0 28	-91.8 -91.8 0.07 (1)	10.00	M-I	0 3662	0.32 (1)	
V-B	-2591 0	0.0 0.0 0.09 (1)	7.81	B-U	0 3314	0.29 (1)	
L-J	-7297 0	0.0 0.0 0.26 (1)	5.54	M-J	0 9930	0.88 (1)	
				Q-G	-297 0	0.12 (1)	
V-U	0 0	-18.5 -18.5 0.63 (1)	10.00	E-O	0 1243	0.15 (1)	
U-T	0 3234	-18.5 -18.5 0.25 (1)	10.00	Q-F	-830 0	0.26 (1)	
T-S	0 3519	-18.5 -18.5 0.25 (1)	10.00				
S-R	0 3312	-18.5 -18.5 0.23 (1)	10.00				
R-O	0 3312	-18.5 -18.5 0.23 (1)	10.00				
O-P	0 4305	-18.5 -18.5 0.30 (1)	10.00				
P-O	0 4305	-18.5 -18.5 0.30 (1)	10.00				
O-N	0 5900	-18.5 -18.5 0.39 (1)	10.00				
N-M	0 9890	-18.5 -18.5 0.79 (1)	10.00				
M-W	0 0	-18.5 -18.5 0.29 (1)	10.00				
W-L	0 0	-18.5 -18.5 0.28 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
M 31-7-8	-5715	-5715	---	BACK	VERT	TOTAL	---	C1
W 33-8-4	-684	-684	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	8.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 085-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17')
CALCULATED VERT. DEFL. (LL) = L/999 (0.12')
ALLOWABLE DEFL. (TL) = L/360 (1.17')
CALCULATED VERT. DEFL. (TL) = L/999 (0.23')

CSI: TC=0.53(1.00 (I-J)), BC=0.79(1.00 (M-N)), WB=0.97(1.00 (N-N)), SSI=0.19(1.00 (L-M))

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1867 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (I) INPUT = 0.90 ;
JSI METAL = 0.91 (I) INPUT = 1.00 ;

Structural component only
DWG# T-2008057 1/2

DESIGN CRITERIA
 SPECIFIED LOADS:
 TOP CH. LL = 25.8 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF
 SPACING = 24.0 IN. CC
 LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12
 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015
 THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018 - CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014
 155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD
 ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.23")
 CSI: TC=0.53(1.00 (1.17)), BC=0.79(1.00 (1.17)), WB=0.97(1.00 (1.17)), SS=0.19(1.00 (1.17))
 DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00
 COMPANION LIVE LOAD FACTOR = 1.00
 AUTOSOLVE HEELS OFF
 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT
 NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1867 788 1887 1656
 PLATE PLACEMENT TOL. = 0.250 inches
 PLATE ROTATION TOL. = 5.0 Deg.
 JSI GRIP = 0.90 (1) INPUT = 0.90
 JSI METAL = 0.91 (1) INPUT = 1.00



Structural component only
 DWG# T-2008057 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408317	T53	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 11:40:05 2020 Page 2

ID:DMCubINVR8TsFoe31v8L_zns11-A11Q7GbQ10IT?AuFYIGGxvz600QZMu0TFaRENsZLYme

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B						
C	TMWW-I	MT20	5.0	8.0	2.50	2.25
D	TMWW-I	MT20	5.0	8.0		
E	TTWW-m	MT20	5.0	8.0	2.25	2.00
F	TMWW-w	MT20	2.0	4.0		
G	TTWW-m	MT20	5.0	8.0	2.25	2.00
H	TMWW-I	MT20	5.0	8.0		
I	TMWW-I	MT20	5.0	8.0	2.50	2.25
J	TMWW-I	MT20	6.0	9.0	2.75	3.75
L	BMV1-I	MT20	7.0	8.0	Edge	1.50
M	BMWW-I	MT20	10.0	12.0		
N	BMWW-I	MT20	5.0	8.0	2.50	2.75
O	BMWW-I	MT20	5.0	8.0		
P	BS-I	MT20	5.0	8.0		
Q	BMWWWW-I	MT20	5.0	8.0		
R	BS-I	MT20	5.0	8.0		
S	BMWW-I	MT20	5.0	8.0		
T	BMWW-I	MT20	5.0	8.0	2.50	2.75
U	BMWW-I	MT20	10.0	12.0		
V						
V	TMBMVW1-I	pMT20	7.0	12.0	9.75	3.50

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

11 C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2008057 112

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408317	T54	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:38 2020 Page 1
ID:DMCubINVR8TsFoe31v6l_zns11-bX8072i44nbklvQd7qV16pVkgB9vD8jSXfKpSzlZV1

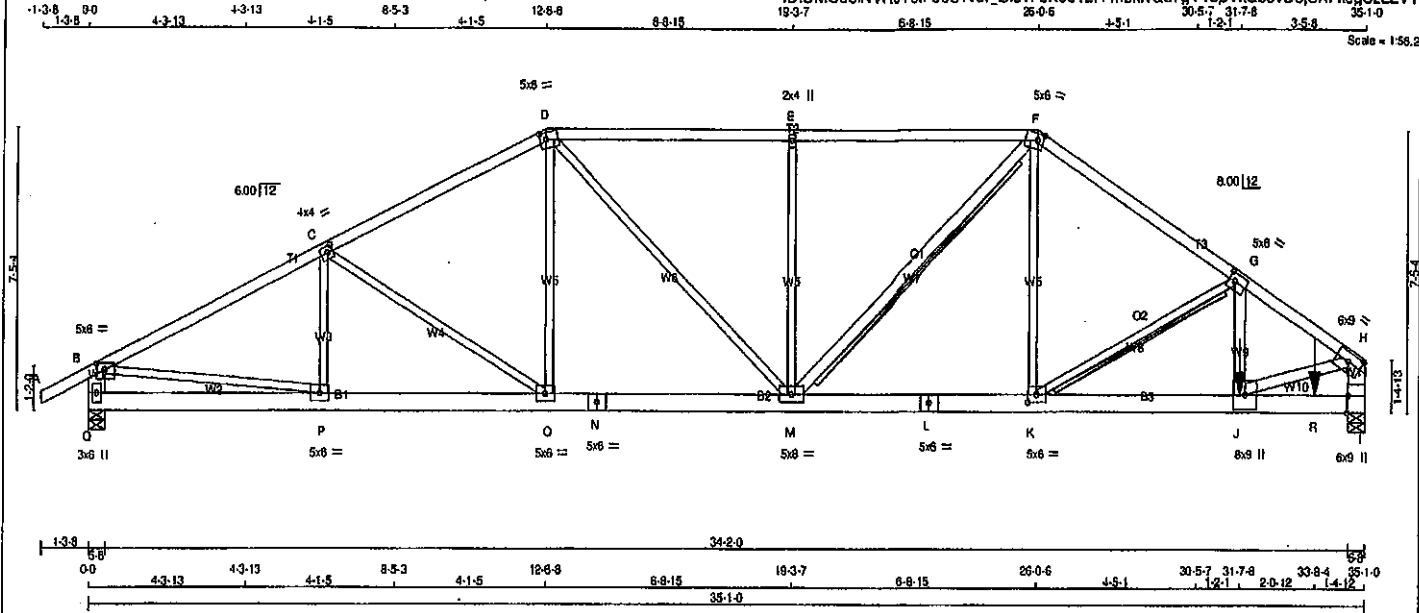

TOTAL WEIGHT = 2 X 171 = 342 lb (M)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - F	2x4	DRY	No.2	SPF		
F - H	2x4	DRY	No.2	SPF		
Q - B	2x6	DRY	No.2	SPF		
I - H	2x6	DRY	No.2	SPF		
Q - N	2x6	DRY	No.2	SPF		
N - L	2x6	DRY	No.2	SPF		
L - I	2x6	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
EXCEPT						
J - G	2x4	DRY	No.2	SPF		
J - H	2x4	DRY	No.2	SPF		
M - F	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-D 1	12	TOP
D-F 1	12	TOP
F-H 1	12	TOP
Q-B 2	12	TOP
I-H 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
Q-N 2	12	TOP
N-L 2	12	TOP
L-I 2	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	SIDE(103.1)
Q-J 2	2	SIDE(137.2)
G-K 1	6	SIDE(137.2)

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	1887	1268 / 0	0 / 0	0 / 0
Q VERT	2673	0	2673	0
I VERT	7985	0	7985	0
JT HORZ	0	0	0	0
Q HORZ	0	0	0	0
I HORZ	0	0	0	0

UNFACTORED REACTIONS

1ST LOASE	MAX./MIN. COMPONENT REACTIONS
JT COMBINED	SNOW
Q COMBINED	SNOW
I COMBINED	SNOW
JT LIVE	0 / 0
Q LIVE	0 / 0
I LIVE	0 / 0
JT PERM. LIVE	0 / 0
Q PERM. LIVE	0 / 0
I PERM. LIVE	0 / 0
JT WIND	0 / 0
Q WIND	0 / 0
I WIND	0 / 0
JT DEAD	631.0
Q DEAD	1888.0
I DEAD	0 / 0
JT SOIL	0 / 0
Q SOIL	0 / 0
I SOIL	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.91 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT G-K, F-M

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSX (LBS)	UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	CSX (LC)	
FR-TO		FROM TO				FR-TO			
A-B	0 / 28	-91.8	-91.8	0.07 (1)	10.00	P-C	-350 / 0	0.06 (1)	
B-C	-4025 / 0	-91.8	-91.8	0.51 (1)	4.29	C-O	-377 / 0	0.20 (1)	
C-D	-3735 / 0	-91.8	-91.8	0.46 (1)	4.44	O-D	0 / 363	0.04 (1)	
D-E	-4129 / 0	-91.8	-91.8	0.56 (1)	4.14	K-F	0 / 2260	0.28 (1)	
E-F	-4129 / 0	-91.8	-91.8	0.56 (1)	4.14	K-G	-4139 / 0	0.88 (1)	
F-G	-4951 / 0	-91.8	-91.8	0.40 (1)	4.05	B-P	0 / 3852	0.45 (1)	
G-H	-9200 / 0	-91.8	-91.8	0.47 (1)	2.91	J-G	0 / 3950	0.35 (1)	
Q-B	-2603 / 0	0.0	0.0	0.09 (1)	7.81	J-H	0 / 7993	0.71 (1)	
I-H	-7441 / 0	0.0	0.0	0.27 (1)	5.49	M-F	-8 / 0	0.00 (4)	
						D-M	0 / 1175	0.15 (1)	
						M-E	-753 / 0	0.38 (1)	
Q-P	0 / 0	-18.5	-18.5	0.05 (4)	10.00				
P-O	0 / 3628	-18.5	-18.5	0.27 (1)	10.00				
O-N	0 / 3316	-18.5	-18.5	0.25 (1)	10.00				
N-M	0 / 3316	-18.5	-18.5	0.25 (1)	10.00				
M-L	0 / 4132	-18.5	-18.5	0.31 (1)	10.00				
L-K	0 / 4132	-18.5	-18.5	0.31 (1)	10.00				
K-J	0 / 7680	-18.5	-18.5	0.61 (1)	10.00				
J-R	0 / 0	-18.5	-18.5	0.28 (1)	10.00				
R-I	0 / 0	-18.5	-18.5	0.28 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
R 31-7.8	-5982	-5982	---	FRONT	VERT	TOTAL	---
J 33-8.4	-684	-684	---	FRONT	VERT	TOTAL	---

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.19")

CSI: TC=0.66/1.00 (D-E:1), BC=0.61/1.00 (J-K:1), WB=0.89/1.00 (G-K:1), SSI=0.17/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.88 (H) (INPUT = 0.80)
JSI METAL= 0.87 (J) (INPUT = 1.00)



Structural component only
DWG# T-2008058 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408317	T54	1	2	TRUSS DESC.		

Jagarack Roof Truss, Burlington


Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Thu Apr 30 10:50:38 2020 Page 2

ID:DMCubINVR6TstF0e31v6I zns11-bX8Q72I44nbkVQd7gY18pVKGb9vD8ISXFkqSzLZV1

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	5.0	6.0	2.00	2.75
C	TMWW-l	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	6.0	2.25	2.00
E	TMW+w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.25	2.00
G	TMWW-l	MT20	5.0	6.0	2.50	2.00
H	TMWW-l	MT20	6.0	9.0	2.75	4.50
I	BMV1-l	MT20	6.0	9.0	Edge	0.50
J	BMWW-h	MT20	8.0	9.0		
K	BMWW-l	MT20	5.0	6.0	2.50	2.75
L	BS-l	MT20	5.0	6.0		
M	BMWWW-l	MT20	5.0	6.0		
N	BS-l	MT20	5.0	6.0		
O	BMWW-l	MT20	5.0	6.0		
P	BMWW-l	MT20	5.0	6.0		
Q	BMV1-p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

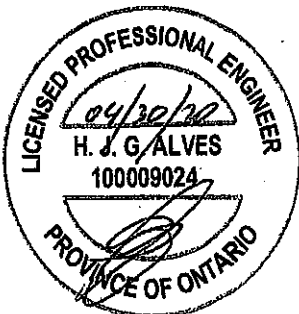

Structural component only
DWG# T-2008058 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408317	T55	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:58:37 2020 Page 1		ID:DMCubINVR6TsiFoe31v6l_zns11-3iOCQgr5jw2_pg00Gf02r?Xeyd4bivTBCuzLZV0	
		1-3-8 0-0 8-0-8 6-0-8 5-10-0 11-10-8 7-3-15 19-2-7 28-6-8 4-2-1 30-8-7 4-1-9 35-1-0 36-4-8		Scale = 1:67.5	

1-3-8 0-0 8-0-8 6-0-8 5-10-0 11-10-8 7-3-15 19-2-7 28-6-8 4-2-1 30-8-7 4-1-9 35-1-0 36-4-8
Scale = 1:67.5

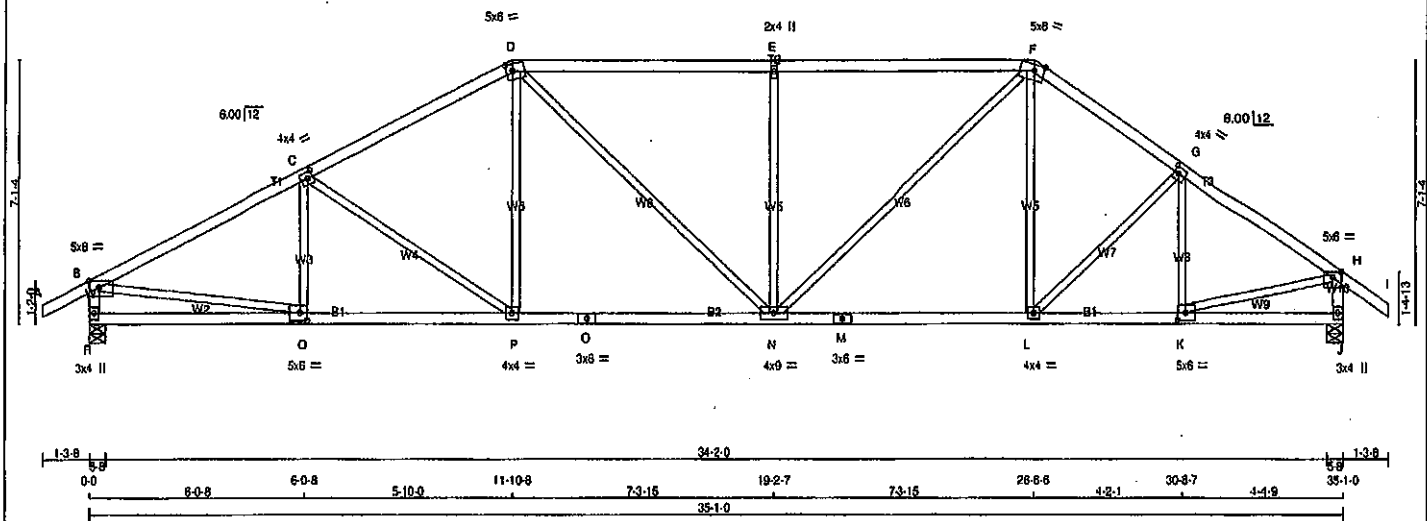

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
R - B	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
R - O	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (to be in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TMVW-l	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	6.0	2.25	2.00
E	TMVW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	8.0	2.00	3.25
G	TMVW-l	MT20	4.0	4.0	2.00	1.50
H	TMVW-p	MT20	5.0	8.0	1.75	3.00
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-l	MT20	5.0	6.0	2.50	2.75
L	BMVW-l	MT20	4.0	4.0		
M	BS-l	MT20	3.0	8.0		
N	BMVW-w-l	MT20	4.0	9.0		
O	BS-l	MT20	3.0	8.0		
P	BMVW-l	MT20	4.0	4.0		
Q	BMVW-l	MT20	5.0	8.0	2.50	2.25
R	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	GROSS REACTION	GROSS REACTION	DOWN	HORZ	BRG	BRG	IN-SX
R	2059	0	2059	0	0	0	5-8	5-8	5-8
J	2060	0	2060	0	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX/MIN COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
R	1453	987 / 0	0 / 0	0 / 0	486 / 0
J	1454	988 / 0	0 / 0	0 / 0	487 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.34 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	MAX. CSI (LC)
FR-TO		FROM	TO	FR-TO			
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00	Q-C	-258 / 8
B-C	-2880 / 0	-91.8	-91.8	0.58 (1)	3.55	C-P	-433 / 0
C-D	-2533 / 0	-91.8	-91.8	0.52 (1)	3.84	P-D	0 / 393
D-E	-2588 / 0	-91.8	-91.8	0.80 (1)	3.34	D-N	0 / 440
E-F	-2586 / 0	-91.8	-91.8	0.80 (1)	3.34	N-E	-828 / 0
F-G	-2250 / 0	-91.8	-91.8	0.27 (1)	4.33	N-F	0 / 977
G-H	-2262 / 0	-91.8	-91.8	0.27 (1)	4.32	L-F	0 / 159
H-I	0 / 35	-91.8	-91.8	0.12 (1)	10.00	L-G	-74 / 0
I-B	-2809 / 0	0.0	0.0	0.20 (1)	5.95	K-G	-401 / 0
J-H	-2021 / 0	0.0	0.0	0.21 (1)	5.94	B-Q	0 / 2827
R-Q	0 / 0	-18.5	-18.5	0.14 (4)	10.00	K-H	0 / 1959
Q-P	0 / 2600	-18.5	-18.5	0.51 (1)	10.00		
P-O	0 / 2244	-18.5	-18.5	0.46 (1)	10.00		
O-N	0 / 2244	-18.5	-18.5	0.46 (1)	10.00		
N-M	0 / 1850	-18.5	-18.5	0.40 (1)	10.00		
M-L	0 / 1850	-18.5	-18.5	0.40 (1)	10.00		
L-K	0 / 1802	-18.5	-18.5	0.39 (1)	10.00		
K-J	0 / 0	-18.5	-18.5	0.08 (4)	10.00		

TOTAL WEIGHT = 145 LB

(M/F)

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN./C/G

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSI: TC=0.80/1.00 (D-E:1), BC=0.51/1.00 (P-Q:1), WB=0.72/1.00 (E-N:1), SS=0.33/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (H) (INPUT = 0.90)
JSI METAL= 0.70 (C) (INPUT = 1.00)

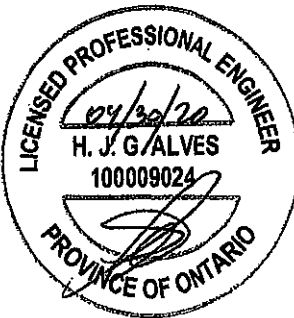

Structural component only
DWG# T-2008059

JOB NAME 408317	TRUSS NAME T56	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:39 2020 Page 1	
ID:DMCubINVR6TstFoe31v6f_zns11-08p8d4yNizJ9M8Cop2kkR7C0o8dQTpuDDyIHnzLZV				35-1-0 35-4-8 1-3-8	
Scale = 1:57.8					

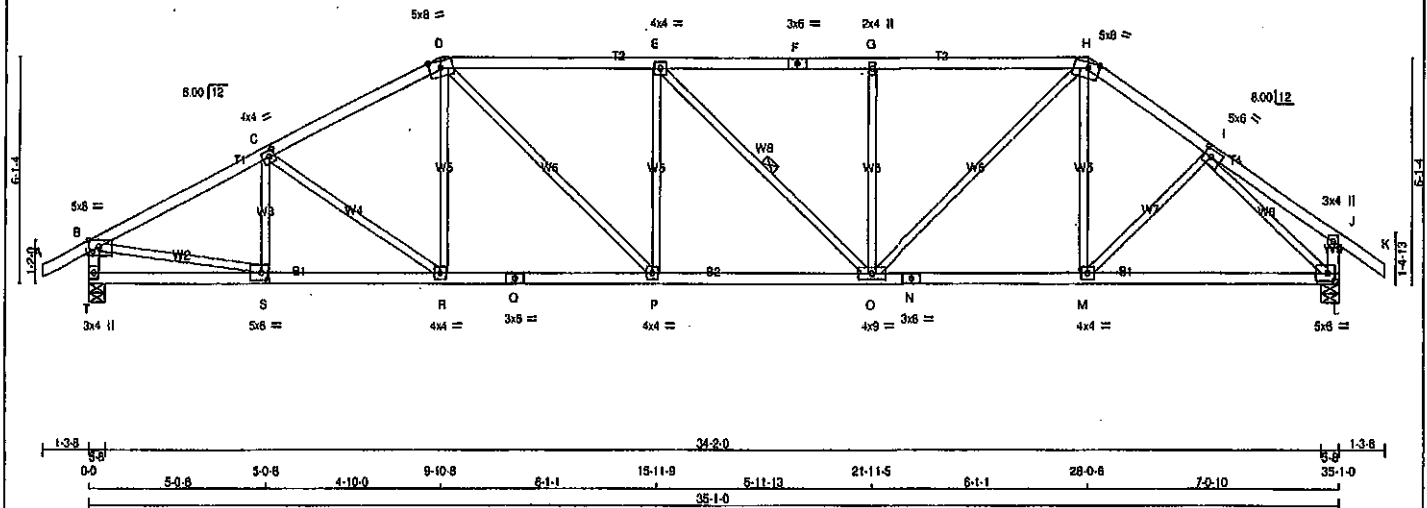

LUMBER				N. L. G. A. RULES	
CHORDS	SIZE	LUMBER	DESCR.	SPF	SPF
A - D	2x4	DRY	No.2	SPF	SPF
B - F	2x4	DRY	No.2	SPF	SPF
F - H	2x4	DRY	No.2	SPF	SPF
H - K	2x4	DRY	No.2	SPF	SPF
T - B	2x4	DRY	No.2	SPF	SPF
T - J	2x4	DRY	No.2	SPF	SPF
T - Q	2x4	DRY	No.2	SPF	SPF
Q - N	2x4	DRY	No.2	SPF	SPF
N - L	2x4	DRY	No.2	SPF	SPF
ALL WEBS	2x3	DRY	No.2	SPF	SPF
EXCEPT					
DRY: SEASONED LUMBER.					

PLATES (tablets in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	Edge	3.50
C TMVW-i	MT20	4.0	4.0	2.00	1.75
D TTWW-m	MT20	5.0	8.0	2.25	3.75
E TMVW-i	MT20	4.0	4.0		
F TS-i	MT20	3.0	6.0		
G TMVW-w	MT20	2.0	4.0		
H TTWW-m	MT20	5.0	8.0	1.75	3.50
I TMVW-i	MT20	5.0	8.0	2.50	2.50
J TMVW-p	MT20	3.0	4.0		
L BMVW-i	MT20	5.0	8.0	2.50	2.25
M P, R					
N BMVW-i	MT20	4.0	4.0		
M BS-i	MT20	3.0	6.0		
O BMVW-w	MT20	4.0	9.0		
Q BS-i	MT20	3.0	8.0		
S BMVW-i	MT20	5.0	6.0	2.50	2.00
T BMVW-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG	BRG
T	2059	0	2059	0	0	5-8	5-8		
L	2060	0	2060	0	0	5-8	5-8		

UNFACTORED REACTIONS		MAX/MIN COMPONENT REACTIONS					
JT	1ST LOASE COMBINED	SNOW	LIVE	PERMLIVE	WIND	DEAD	SOIL
T	1483	987 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1454	968 / 0	0 / 0	0 / 0	0 / 0	487 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.39 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MEMB.		WEBS	
MAX. FACTORED	FORCE	MAX. FACTORED	FORCE	MAX. FACTORED	FORCE
FR-TO	FROM TO	FR-TO	FROM TO	FR-TO	FROM TO
A-B	0/0	-91.8	-91.8	0.12 (1)	10.00
B-C	-2828/0	-91.8	-91.8	0.54 (1)	3.65
C-D	-2874/0	-91.8	-91.8	0.51 (1)	3.75
D-E	-2958/0	-91.8	-91.8	0.72 (1)	3.39
E-F	-2795/0	-91.8	-91.8	0.68 (1)	3.50
F-G	-2795/0	-91.8	-91.8	0.68 (1)	3.50
G-H	-2795/0	-91.8	-91.8	0.68 (1)	3.50
H-I	-2299/0	-91.8	-91.8	0.23 (1)	4.32
I-J	0/18	-91.8	-91.8	0.16 (1)	10.00
J-K	0/35	-91.8	-91.8	0.12 (1)	10.00
T-B	-2015/0	0.0	0.0	0.20 (1)	5.95
L-J	-255/0	0.0	0.0	0.03 (1)	7.81

MEMB.	FORCE	MAX. FACTORED	FORCE	MAX. FACTORED	FORCE
FR-TO	FROM TO	FR-TO	FROM TO	FR-TO	FROM TO
T-S	0/0	-18.5	-18.5	0.10 (4)	10.00
S-R	0/2649	-18.5	-18.5	0.48 (1)	10.00
R-Q	0/2374	-18.5	-18.5	0.45 (1)	10.00
Q-P	0/2374	-18.5	-18.5	0.45 (1)	10.00
P-O	0/2868	-18.5	-18.5	0.54 (1)	10.00
O-N	0/1895	-18.5	-18.5	0.42 (1)	10.00
N-M	0/1895	-18.5	-18.5	0.42 (1)	10.00
M-L	0/1797	-18.5	-18.5	0.40 (1)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/980 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.18")
ALLOWABLE DEFL.(TL) = L/800 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.31")

CSI: TO=0.72/1.00 (D-E:1), BC=0.54/1.00 (O-P:1), WB=0.98/1.00 (I-L:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.90 (L) (INPUT = 0.90)
JSI METAL = 0.74 (Q) (INPUT = 1.00)

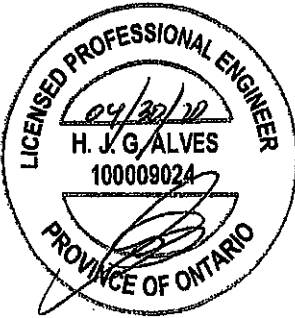

Structural component only
DWG# T-2008060

JOB NAME 408317	TRUSS NAME T57	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:50:40 2020 Page 1
 ID:DMCubINVR6TstF0a31v6l_zns11-UINXqQia805AnWjOMWazHfgO_CWuSzF2SiroDzLZUz
 35-1-0 36-4-8 1-3-8
 Scale = 1:57.5

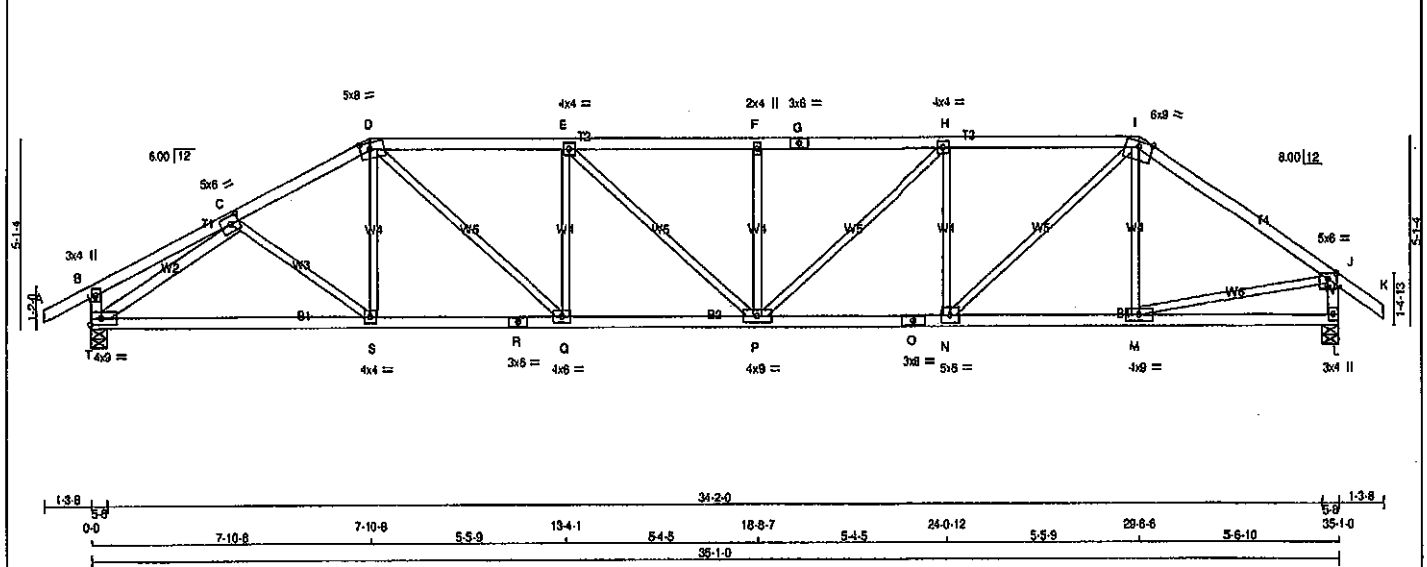

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - K	2x4	DRY	No.2
T - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
T - R	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
T - C	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (Table in inches)			
JT TYPE	PLATES	W	LEN Y X
B TMW-p	MT20	3.0	4.0
C TMWW-I	MT20	5.0	6.0 2.50 2.75
D TTWW-m	MT20	5.0	8.0 2.00 3.25
E TMWW-I	MT20	4.0	4.0
F TMW-w	MT20	2.0	4.0
G TS-I	MT20	3.0	6.0
H TMWW-I	MT20	4.0	4.0
I TTWW-m	MT20	6.0	9.0 Edge
J TMWW-p	MT20	5.0	8.0 1.75 3.00
L BMW1-p	MT20	3.0	4.0
M BMWW-I	MT20	4.0	9.0
N BMWW-I	MT20	5.0	6.0
O BS-I	MT20	3.0	8.0
P BMWWW-I	MT20	4.0	9.0
Q BMWW-I	MT20	4.0	6.0
R BS-I	MT20	3.0	6.0
S BMWW-I	MT20	4.0	4.0
T BMWW-I	MT20	4.0	9.0 Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	HORIZ	DOWN	HORIZ
T 2059	0	2059	0
L 2060	0	2060	0

UNFACTORED REACTIONS

1ST LOSE	MAX/MIN	COMPONENT REACTIONS
JT COMBINED	SNOW	LIVE
T 1453	967 / 0	0 / 0
L 1454	968 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.16 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)
FR-TO			
A-B	0 / 28	-91.8	-91.8 0.12 (1)
B-C	0 / 16	-91.8	-91.8 0.20 (1)
C-D	-2790 / 0	-91.8	-91.8 0.31 (1)
D-E	-3383 / 0	-91.8	-91.8 0.65 (1)
E-F	-3551 / 0	-91.8	-91.8 0.67 (1)
F-G	-3551 / 0	-91.8	-91.8 0.67 (1)
G-H	-3551 / 0	-91.8	-91.8 0.67 (1)
H-I	-3100 / 0	-91.8	-91.8 0.81 (1)
I-J	-2269 / 0	-91.8	-91.8 0.70 (1)
J-K	0 / 35	-91.8	-91.8 0.12 (1)
T-B	-270 / 0	0.0	0.0 0.03 (1)
L-J	-2017 / 0	0.0	0.0 0.21 (1)
T-S	0 / 2410	-18.5	-18.5 0.53 (1)
S-R	0 / 2480	-18.5	-18.5 0.53 (1)
R-Q	0 / 2480	-18.5	-18.5 0.53 (1)
Q-P	0 / 3383	-18.5	-18.5 0.80 (1)
P-O	0 / 3100	-18.5	-18.5 0.55 (1)
O-N	0 / 3100	-18.5	-18.5 0.55 (1)
N-M	0 / 1697	-18.5	-18.5 0.38 (1)
M-L	0 / 0	-18.5	-18.5 0.14 (4)

WEBS

MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC1)
FR-TO		
C-S	0 / 92	0.03 (4)
S-D	0 / 117	0.04 (4)
D-Q	0 / 1201	0.27 (1)
Q-E	-712 / 0	0.27 (1)
E-P	0 / 226	0.05 (1)
P-F	-454 / 0	0.17 (1)
F-H	0 / 607	0.14 (1)
H-N	-983 / 0	0.37 (1)
N-I	0 / 1601	0.38 (1)
I-M	-247 / 5	0.09 (1)
T-C	-2985 / 0	0.82 (1)
M-J	0 / 1936	0.44 (1)

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2018 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CSI: TC=0.70/1.00 (K-J:1), BC=0.80/1.00 (P-Q:1), WB=0.82/1.00 (C-T:1), SS=0.23/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PS) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1867 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (J) (INPUT = 0.90)
 JSI METAL= 0.90 (O) (INPUT = 1.00)



Structural component only
 DWG# T-2008061

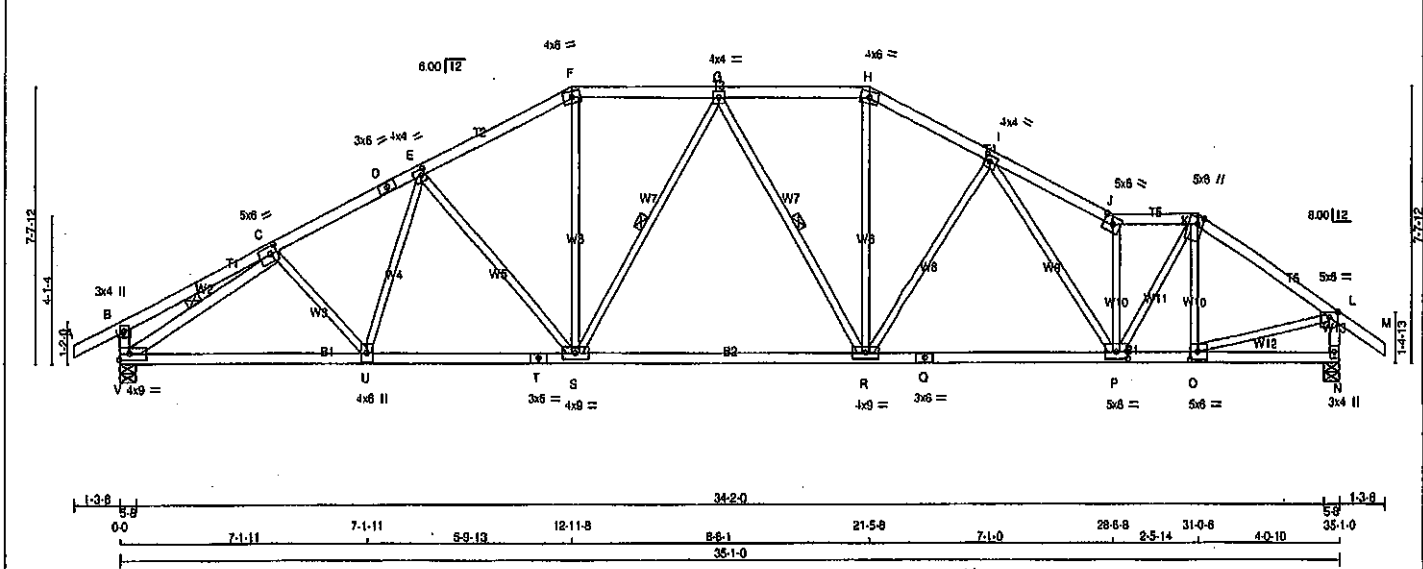

LUMBER

N.L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF
J - K	2x4	DRY	No.2	SPF
K - M	2x4	DRY	No.2	SPF
V - B	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF
V - T	2x4	DRY	No.2	SPF
T - Q	2x4	DRY	No.2	SPF
Q - N	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
V - C	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMVW-t	MT20	5.0	6.0	2.50	2.25
D TS-I	MT20	3.0	8.0		
E TMVW-t	MT20	4.0	4.0	2.00	1.25
F TTW-m	MT20	4.0	8.0		
G TMVW-t	MT20	4.0	4.0		
H TTW-m	MT20	4.0	8.0		
I TMVW-t	MT20	4.0	4.0	2.00	1.75
J TTW-h	MT20	5.0	6.0	2.50	3.25
K TTW+m	MT20	5.0	8.0	2.25	1.75
L TMVW-p	MT20	5.0	8.0	1.75	3.00
N BMV+p	MT20	3.0	4.0		
O BMVW-t	MT20	5.0	6.0	2.50	2.75
P BMVW-t	MT20	5.0	8.0	2.25	4.00
Q BS-I	MT20	3.0	8.0		
R BMVW-t	MT20	4.0	9.0		
S BMVW-t	MT20	4.0	9.0		
T BS-I	MT20	3.0	8.0		
U BMVW-t	MT20	4.0	6.0		
V BMVW-t	MT20	4.0	9.0		Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
	VERT	HORZ	DOWN	BRG
JT	2059	0	2059	0
V	2059	0	2059	0
N	2060	0	2060	0

UNFACTORED REACTIONS

	1ST LCASE	MAX MIN. COMPONENT REACTIONS
	JT	SNOW
V	1453	987.0
N	1454	988.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.67 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-S, G-R, C-V.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED	FACTORED	MAX. FACTORED	FACTORED
	FORCE (LBS)	VERT. LOAD (PLF)	FORCE (LBS)	FORCE (LBS)
FR-TO				
A-B	0/28	-91.8	0/77	0.03 (4)
B-C	0/15	-91.8	0/86	0.04 (4)
C-D	-2780/0	-91.8	-474/0	0.42 (1)
D-E	-2780/0	-91.8	0/769	0.16 (1)
E-F	-2429/0	-91.8	-317/0	0.18 (1)
F-G	-2167/0	-91.8	-222/0	0.11 (1)
G-H	-2213/0	-91.8	0/826	0.20 (1)
H-I	-2481/0	-91.8	-563/0	0.47 (1)
I-J	-3018/0	-91.8	0/378	0.08 (1)
J-K	-2874/0	-91.8	-1585/0	0.43 (1)
K-L	-2219/0	-91.8	-2991/0	0.50 (1)
L-M	0/35	-91.8	-411/0	0.11 (1)
V-B	-291/0	0.0	0/1583	0.39 (1)
N-L	-2027/0	0.0	0/1904	0.47 (1)
V-U	0/2454	-18.5		10.00
U-T	0/2460	-18.5		10.00
T-S	0/2460	-18.5		10.00
S-R	0/2322	-18.5		10.00
R-Q	0/2510	-18.5		10.00
Q-P	0/2510	-18.5		10.00
P-O	0/1832	-18.5		10.00
O-N	0/0	-18.5		10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24" IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2015, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')

CALCULATED VERT. DEFL.(LL) = L/999 (0.14')

ALLOWABLE DEFL.(TL) = L/360 (1.17')

CALCULATED VERT. DEFL.(TL) = L/999 (0.31')

CSI: TC=0.38/1.00 (C-E:1), BC=0.81/1.00 (P-R:1), WB=0.50/1.00 (G-V:1), SS=0.21/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.90 (K) (INPUT = 0.90)

JSI METAL = 0.75 (T) (INPUT = 1.00)

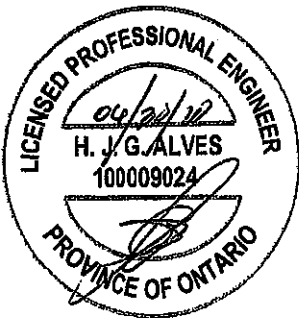

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408317	T59	1	2	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington	Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 10:50:43 2020 Page 1
1-3-8 0-0 5-10-8 5-10-8 5-8-10 11-7-2 13-6-8 15-5-12 15-5-8 17-2-8 17-5-12 18-8-8 20-10-8 22-9-14 22-0 1-11-6 5-8-10 28-6-8 5-10-8 34-5-0 35-8-8 1-3-8	ID:DMCubINVR6TslFoe31v8l_zns11-ul3ITSITxTlezSz17gwHlu8QTSMinU8rwWPYzLZUw
Scale = 1:50.5	

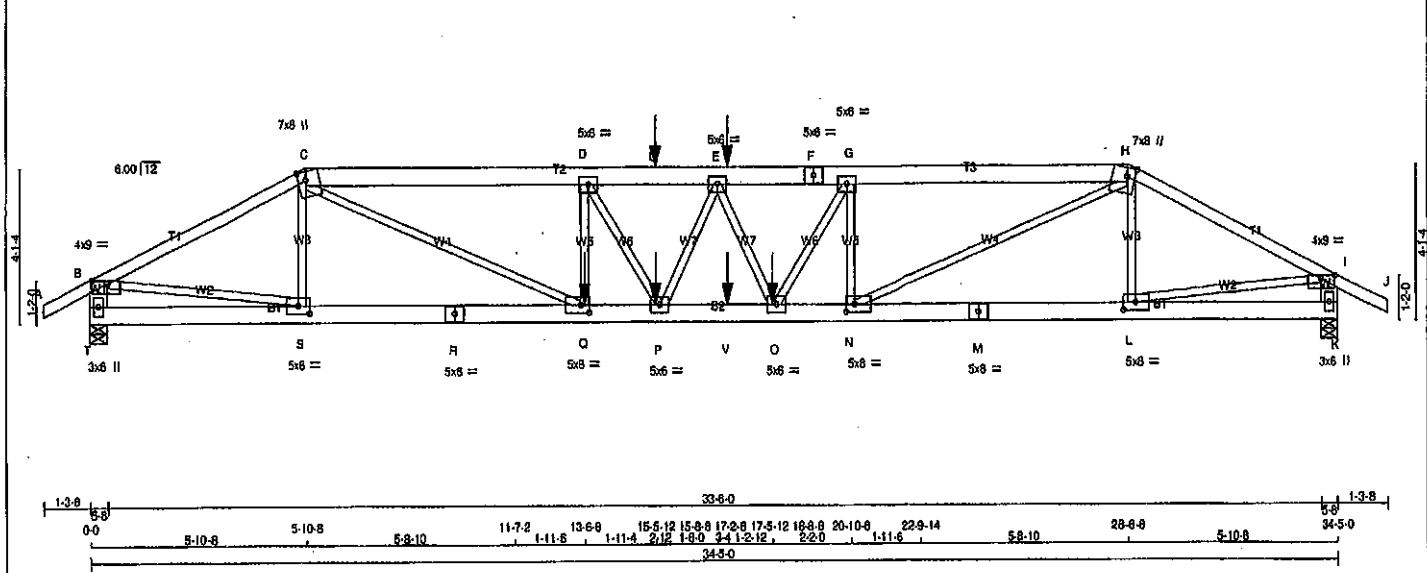

LUMBER	ALL WEBS 2x3 DRY No.2	SPF	EXCEPT
--------	-----------------------	-----	--------

N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - F	2x6	DRY	No.2	SPF	
F - H	2x6	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
J - L	2x6	DRY	No.2	SPF	
L - M	2x6	DRY	No.2	SPF	
M - K	2x6	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(P/LF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
H - J	12	TOP
C - F	12	TOP
F - H	12	TOP
T - B	12	TOP
K - I	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
T - R	12	TOP
R - M	12	TOP
M - K	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
Q - D	8	TOP
2x3	8	TOP

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
T	4094	0	4094	0	0
K	3933	0	3933	0	0

UNFACTORED REACTIONS	1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
T	2885	1851 / 0	0 / 0
K	2772	1872 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.22 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX FACTORED	FORCE (LBS)	VERT. LOAD	LOC1	MAX	MAX. UNBRAC	MEMB.	MAX. FACTORED	FORCE (LBS)	MAX
FR-TO											
A-B	0 / 28	-91.8	-91.8	0.07 (1)	10.00	S-C	-588 / 0	0.07 (1)			
B-C	-6510 / 0	-91.8	-91.8	0.04 (1)	3.39	L-H	-577 / 0	0.07 (1)			
C-D	-11958 / 0	-91.8	-91.8	0.04 (1)	3.32	B-S	0 / 5888	0.73 (1)			
D-U	-12303 / 0	-91.8	-91.8	0.04 (1)	3.31	L-I	0 / 5621	0.70 (1)			
U-E	-12486 / 0	-91.8	-91.8	0.04 (1)	3.31	P-E	-392 / 0	0.05 (1)			
E-F	-12486 / 0	-91.8	-91.8	0.03 (1)	3.30	E-O	0 / 60	0.01 (1)			
F-G	-12486 / 0	-91.8	-91.8	0.03 (1)	3.30	Q-D	-1367 / 0	0.18 (1)			
G-H	-11395 / 0	-91.8	-91.8	0.01 (1)	3.31	N-G	-2829 / 0	0.31 (1)			
H-I	-6215 / 0	-91.8	-91.8	0.02 (1)	3.47	D-P	0 / 706	0.09 (1)			
I-J	0 / 28	-91.8	-91.8	0.07 (1)	10.00	O-G	0 / 2219	0.27 (1)			
T-B	-4082 / 0	0.0	0.0	0.14 (1)	7.08	C-Q	0 / 6770	0.84 (1)			
K-I	-3896 / 0	0.0	0.0	0.14 (1)	7.17	N-H	0 / 6441	0.80 (1)			

CHORDS	MEMB.	MAX FACTORED	FORCE (LBS)	VERT. LOAD	LOC1	MAX	MAX. UNBRAC	MEMB.	MAX. FACTORED	FORCE (LBS)	MAX
FR-TO											
T-S	0 / 0	-18.5	-18.5	0.08 (4)	10.00						
S-R	0 / 5853	-18.5	-18.5	0.08 (1)	10.00						
R-Q	0 / 5853	-18.5	-18.5	0.08 (1)	10.00						
Q-P	0 / 11958	-18.5	-18.5	0.07 (1)	10.00						
P-V	0 / 12462	-18.5	-18.5	0.03 (1)	10.00						
V-O	0 / 12462	-18.5	-18.5	0.03 (1)	10.00						
O-N	0 / 11395	-18.5	-18.5	0.08 (1)	10.00						
N-M	0 / 5588	-18.5	-18.5	0.03 (1)	10.00						
M-L	0 / 5588	-18.5	-18.5	0.03 (1)	10.00						
L-K	0 / 0	-18.5	-18.5	0.06 (4)	10.00						

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LOC1	MAX	FACE	DIR.	TYPE	HEEL	CONN.
E	17-5-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
O	18-8-8	-2098	-2098	---	BACK	VERT	TOTAL	---	C1
P	15-5-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
Q	13-6-8	-1811	-1811	---	BACK	VERT	TOTAL	---	C1
U	15-5-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	17-5-12	-26	-26	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.15")

CALCULATED VERT. DEFL.(LL) = U/899 (0.34")

ALLOWABLE DEFL.(TL) = L/360 (1.15")

CALCULATED VERT. DEFL.(TL) = U/671 (0.82")

CSI: TC=0.64/1.00 (B-C:1), BC=0.93/1.00 (O-P:1), WB=0.84/1.00 (C-Q:1), SS=0.13/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE FEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.88 (N) (INPUT = 0.90)

JSI METAL=0.80 (R) (INPUT = 1.00)



Structural component only


DWG# T-2008063 1/2

JOB NAME 408317	TRUSS NAME T59	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:43 2020 Page 2
ID:DMCubNVR6TsIFoe31v6Lzns1I-ut3ITSjTRxTazSz17ouHlu8QTSMInU8rwWPYzLZUw

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	4.0	9.0	1.00	4.75
C	TTWW+m	MT20	7.0	8.0	2.75	2.50
D, E, G						
D	TMWW-t	MT20	5.0	6.0		
F	TS-t	MT20	5.0	6.0		
H	TTWW+m	MT20	7.0	8.0	2.75	2.50
I	TMWW-p	MT20	4.0	9.0	1.00	4.75
K	BMV1+p	MT20	3.0	6.0		
L	BMWW-t	MT20	5.0	8.0	2.50	3.75
M	BS-t	MT20	5.0	6.0		
N	BMWW-t	MT20	5.0	8.0	2.50	2.75
O	BMWW-t	MT20	5.0	6.0		
P	BMWW-t	MT20	5.0	6.0		
Q	BMWW-t	MT20	5.0	8.0	2.50	2.75
R	BS-t	MT20	5.0	6.0		
S	BMWW-t	MT20	5.0	8.0	2.50	3.75
T	BMV1+p	MT20	3.0	6.0		

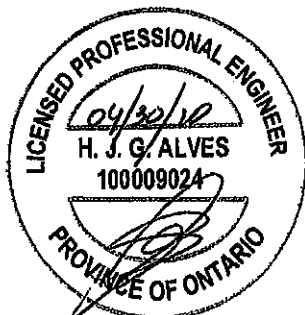

Structural component only
DWG# T-2008063

JOB NAME 408317	TRUSS NAME T60X	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 6.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:44 2020 Page 1
ID:DMCubINVR6TstFos31v8I_zns11-M4d1gom5CFbcG71AbMevRVq0bptP5jzdMVg3x_zLZUv

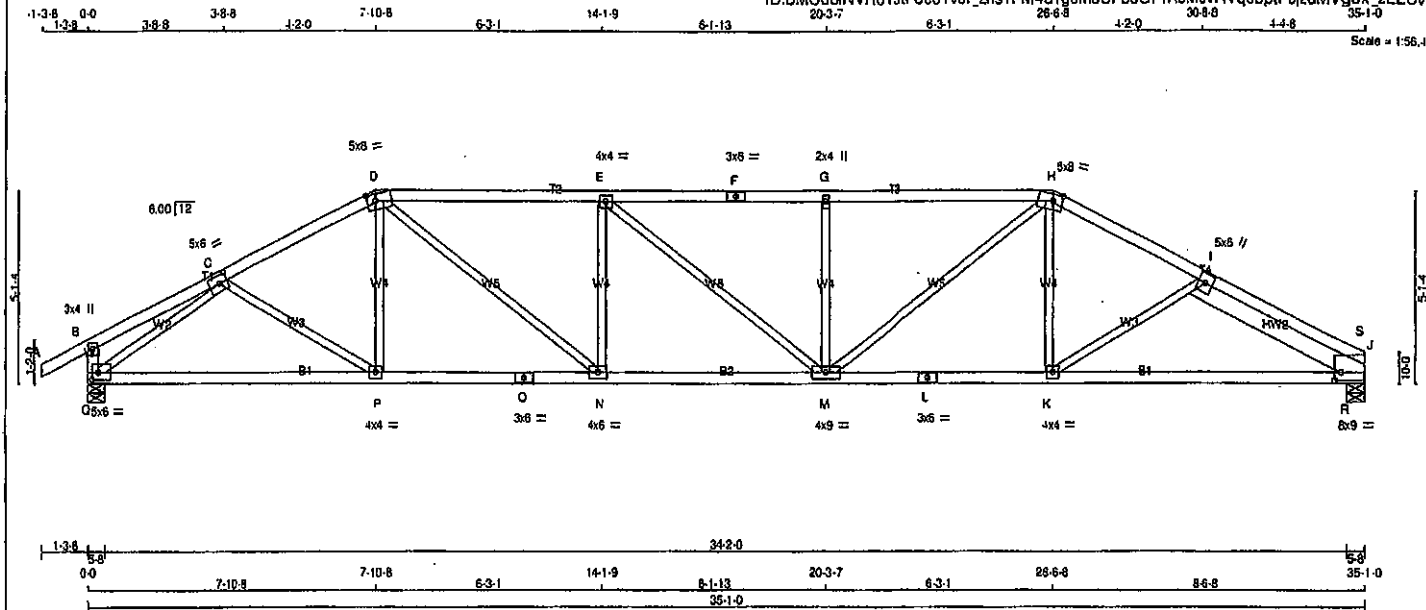

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
J - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - O	2x4	DRY	No.2
O - P	2x4	DRY	No.2
P - Q	2x4	DRY	No.2
Q - R	2x4	DRY	No.2
R - S	2x4	DRY	No.2
S - T	2x4	DRY	No.2
T - U	2x4	DRY	No.2
U - V	2x4	DRY	No.2
V - W	2x4	DRY	No.2
W - X	2x4	DRY	No.2
X - Y	2x4	DRY	No.2
Y - Z	2x4	DRY	No.2
Z - A	2x4	DRY	No.2
REINFORCING MEMBERS			
HW2	2x8	DRY	No.2
ALL WEBS 2x3 DRY No.2			
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table in inches)			
JT TYPE	PLATES	W	LEN Y X
B TMV+p	MT20	3.0	4.0
C TMVW-i	MT20	5.0	6.0 2.50 2.75
D TTWW-m	MT20	5.0	8.0 2.25 2.75
E TMVW-i	MT20	4.0	4.0
F TS-i	MT20	3.0	6.0
G TMVW-w	MT20	2.0	4.0
H TTWW-m	MT20	5.0	8.0 2.25 3.25
I TMVW-i	MT20	5.0	8.0
J TMBMW-i	MT20	8.0	9.0 2.50 2.00
K BMMW-i	MT20	4.0	4.0
L BS-i	MT20	3.0	6.0
M BMMW-w	MT20	4.0	9.0
N BMMW-i	MT20	4.0	6.0
O BS-i	MT20	3.0	6.0
P BMMW-i	MT20	4.0	4.0
Q BMMW-i	MT20	5.0	6.0 2.25 2.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
<u>BEARINGS</u>							
	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG		
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
J	1934	0	1934	0	0	5-8	5-8
Q	2059	0	2059	0	0	5-8	5-8
<u>UNFACTORED REACTIONS</u>							
	1ST LCASE		MAX/MIN. COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	1368	888 / 0	0 / 0	0 / 0	0 / 0	470 - 0	0 / 0
Q	1453	987 / 0	0 / 0	0 / 0	0 / 0	488 - 0	0 / 0
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, Q							
<u>BRACING</u>							
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.02 FT.							
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.							
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.							
<u>LOADING</u>							
TOTAL LOAD CASES: (4)							

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. GSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. GSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-91.8 -91.8 0.12 (1)	10.00	C-P	0 / 130	0.04 (4)	
B-C	0 / 17	-91.8 -91.8 0.19 (1)	10.00	D-Q	0 / 118	0.04 (4)	
C-D	-2789 / 0	-91.8 -91.8 0.32 (1)	3.89	E-N	0 / 1246	0.23 (1)	
D-E	-3489 / 0	-91.8 -91.8 0.85 (1)	3.05	F-M	-855 / 0	0.25 (1)	
E-F	-3515 / 0	-91.8 -91.8 0.85 (1)	3.02	G-H	0 / 59	0.01 (1)	
F-G	-3515 / 0	-91.8 -91.8 0.85 (1)	3.02	H-I	-617 / 0	0.24 (1)	
G-H	-3515 / 0	-91.8 -91.8 0.85 (1)	3.03	I-J	0 / 1128	0.25 (1)	
H-I	-2942 / 0	-91.8 -91.8 0.33 (1)	3.80	J-K	0 / 231	0.06 (4)	
I-J	-1483 / 0	-91.8 -91.8 0.23 (1)	5.13	K-L	-184 / 0	0.07 (1)	
J-K	-2458 / 0	-91.8 -91.8 0.16 (1)	4.26	L-M	-2942 / 0	0.97 (1)	
K-L	-262 / 0	0.0 0.0 0.03 (1)	7.81	M-N	0 / 1217	0.00 (1)	
L-M				N-O	-1727 / 0	0.34 (1)	
M-N	0 / 2368	-18.5 -18.5 0.52 (1)	10.00	O-P			
N-O	0 / 2481	-18.5 -18.5 0.53 (1)	10.00	P-Q			
O-P	0 / 2481	-18.5 -18.5 0.53 (1)	10.00	Q-R			
P-Q	0 / 3469	-18.5 -18.5 0.83 (1)	10.00	R-S			
Q-R	0 / 2621	-18.5 -18.5 0.54 (1)	10.00	S-T			
R-S	0 / 2621	-18.5 -18.5 0.54 (1)	10.00	T-U			
S-T	0 / 2754	-18.5 -18.5 0.56 (1)	10.00	U-V			
T-U	0 / 1333	-18.5 -18.5 0.35 (4)	10.00	V-W			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 21.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OSC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (1.17")
CALCULATED VERT. DEFL.(LL) = L/989 (0.21")
ALLOWABLE DEFL.(TL) = L/380 (1.17")
CALCULATED VERT. DEFL.(TL) = L/989 (0.40")

CSK: TC=0.85/1.00 (G-H:1), BC=0.83/1.00 (M-N:1),
WB=0.97/1.00 (C-Q:1), SS=0.23/1.00 (J-R:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (H) (INPUT = 0.90)
JSI METAL = 0.81 (L) (INPUT = 1.00)



Structural component only
DWG# T-2008064


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408317	T61X	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:45 2020 Page 1

ID:DMCubINVR6TslFoe31v6l_zns1l-qGBQu7mizYTuHcM8398_INBBDB8qGHnb9PcTqZLZUu

1-3-8 0-0 5-0-8 5-0-8 1-10-0 9-10-8 7-4-0 17-2-8 7-4-0 24-6-8 1-10-0 29-4-8 5-8-8 35-1-0
Scale = 1:50.5

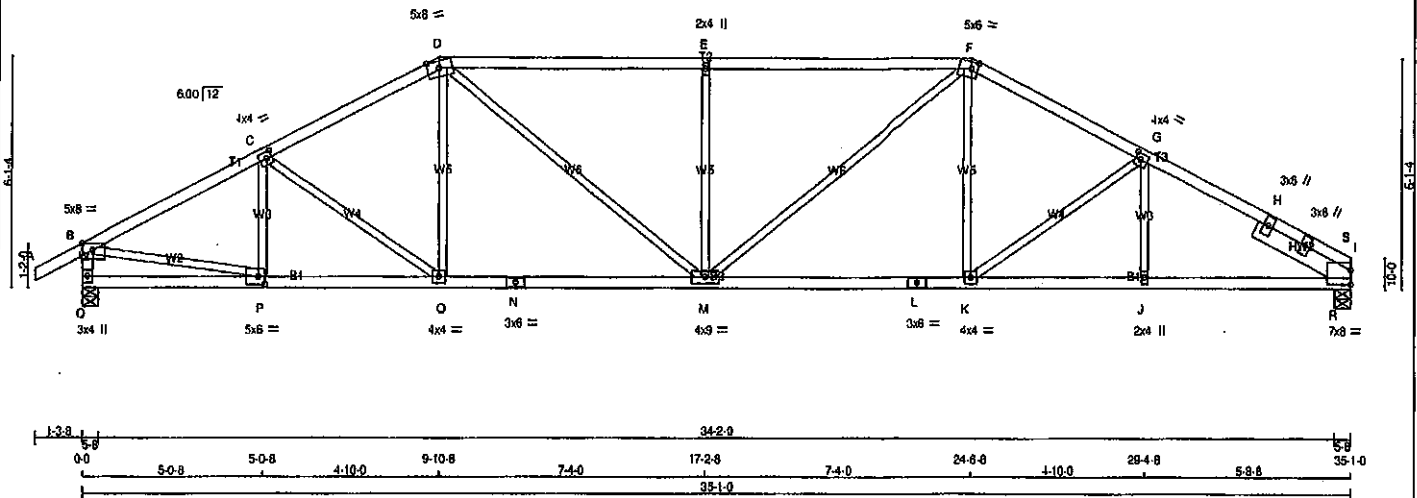

TOTAL WEIGHT = 137 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	QESOR.	
A - D	2x4	DRY No.2	SPF	
E - F	2x4	DRY No.2	SPF	
F - I	2x4	DRY No.2	SPF	
Q - B	2x4	DRY No.2	SPF	
O - N	2x4	DRY No.2	SPF	
N - L	2x4	DRY No.2	SPF	
L - I	2x4	DRY No.2	SPF	
REINFORCING MEMBERS				
HW2	2x6	DRY No.2	SPF	
ALL WEBS 2x3 DRY EXCEPT				
DRY: SEASONED LUMBER.				

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	8.0	Edge 3.50
C	TMVW-1	MT20	4.0	4.0	2.00 1.75
D	TTVW-m	MT20	5.0	8.0	2.25 3.75
E	TMVW-w	MT20	2.0	4.0	
F	TTVW-m	MT20	5.0	8.0	2.25 2.00
G	TMVW-1	MT20	4.0	4.0	2.00 1.75
I	TMBMR-1	MT20	7.0	8.0	4.50
I	RT-1	MT20	3.0	8.0	
J	RT-1	MT20	3.0	8.0	
K	BMVW-w	MT20	2.0	4.0	
L	BS-1	MT20	4.0	4.0	
M	BMVW-w	MT20	4.0	4.0	
N	BS-1	MT20	3.0	8.0	
O	BMVW-1	MT20	4.0	4.0	
P	BMVW-1	MT20	5.0	6.0	2.50 2.00
Q	BMV-1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED	MAXIMUM FACTORED	INPUT	RECORD	
	GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
I	1934	0	1934	0	0
Q	2059	0	2059	0	0

UNFACTORED REACTIONS					
	1ST LOASE	MAX/MIN	COMPONENT REACTIONS		
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
I	1368	888 / 0	0 / 0	0 / 0	0 / 0
Q	1453	967 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, Q

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORZ. LOAD (LBS)	
FR-TO	FROM	TO	LENGTH	FR-TO	FROM	TO	LENGTH
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	P-C	-351 / 0	0.08 (1)
B-C	-2827 / 0	-91.8	-91.8 0.39 (1)	3.81	C-O	-213 / 0	0.13 (1)
C-D	-2678 / 0	-91.8	-91.8 0.37 (1)	3.92	O-D	0 / 244	0.08 (4)
D-E	-3031 / 0	-91.8	-91.8 0.88 (1)	3.03	D-M	0 / 835	0.19 (1)
E-F	-3031 / 0	-91.8	-91.8 0.88 (1)	3.03	M-E	-928 / 0	0.48 (1)
F-G	-2763 / 0	-91.8	-91.8 0.45 (1)	3.77	M-F	0 / 713	0.16 (1)
G-H	-2210 / 0	-91.8	-91.8 0.53 (1)	4.02	K-F	0 / 321	0.07 (1)
H-S	-2210 / 0	-91.8	-91.8 0.53 (1)	4.02	K-G	-315 / 0	0.20 (1)
S-I	-2714 / 0	-91.8	-91.8 0.17 (1)	4.09	J-G	0 / 71	0.02 (4)
Q-B	-2014 / 0	0.0	0.0 0.20 (1)	5.95	B-P	0 / 2585	0.58 (1)
					R-S	0 / 1839	0.00 (1)
					R-H	-1903 / 0	0.16 (1)
Q-P	0 / 0	-18.5	-18.5 0.10 (4)	10.00			
P-O	0 / 2548	-18.5	-18.5 0.50 (1)	10.00			
O-N	0 / 2377	-18.5	-18.5 0.47 (1)	10.00			
N-M	0 / 2377	-18.5	-18.5 0.47 (1)	10.00			
M-L	0 / 2472	-18.5	-18.5 0.51 (1)	10.00			
L-K	0 / 2472	-18.5	-18.5 0.51 (1)	10.00			
K-J	0 / 2727	-18.5	-18.5 0.55 (1)	10.00			
J-R	0 / 2727	-18.5	-18.5 0.73 (1)	10.00			
R-I	0 / 1301	-18.5	-18.5 0.50 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN.C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2018 AMENDMENT)
- CSA 098-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.18")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.35")

CSI: TC=0.89/1.00 (D-E:1), BC=0.73/1.00 (J-R:1), WB=0.58/1.00 (B-P:1), SI=0.37/1.00 (I-R:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (F) (INPUT = 0.90)
JSI METAL = 0.98 (I) (INPUT = 1.00)



Structural component only
DWG# T-2008065

JOB NAME 408317	TRUSS NAME T62X	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tarparack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:46 2020 Page 1			

ID:DMCubINVR6TstFoe31v8I_zns11-JSlc5TnLsrKVRBYingNWwwQNdY4ZjNwqp9A0tZL2Ut
Scale = 1:55.8

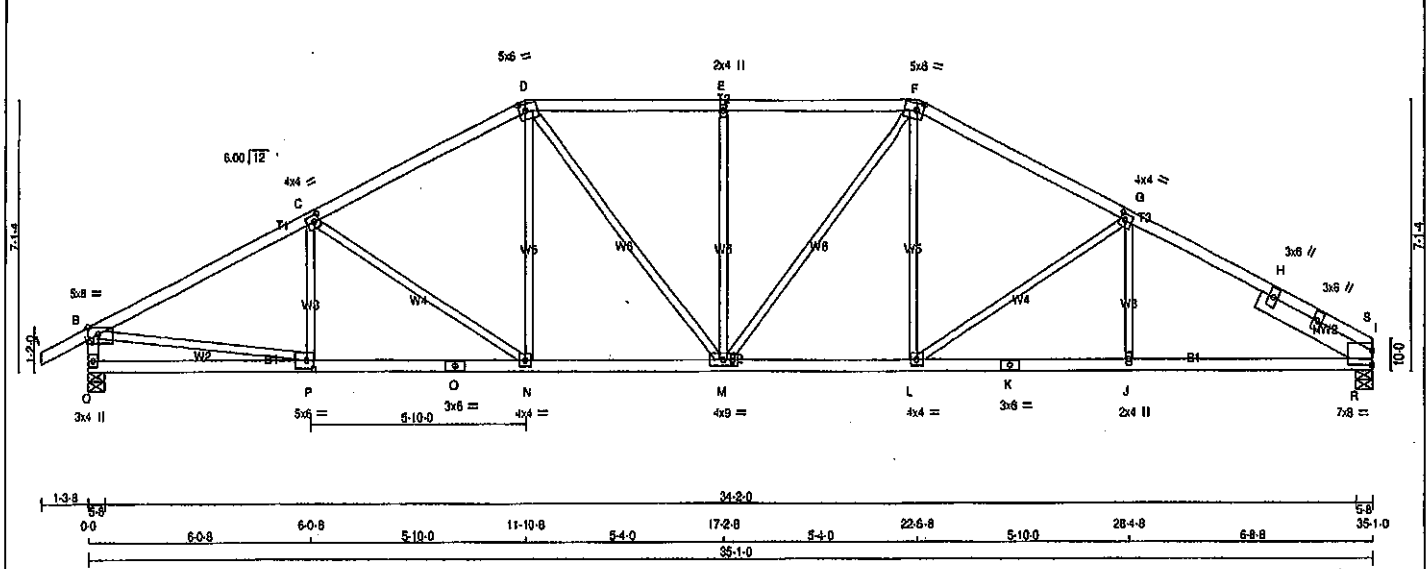

LUMBER				DESCR	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
Q - B	2x4	DRY	No.2	SPF	
Q - O	2x4	DRY	No.2	SPF	
O - K	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
REINFORCING MEMBERS				DESCR	
HW2	2x8	DRY	No.2	SPF	
ALL WEBS				DESCR	
EXCEPT	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	8.0	Edge 3.50
C	TMVW-l	MT20	4.0	4.0	2.00 1.75
D	TTWW-m	MT20	5.0	8.0	2.25 2.00
E	TMVW-w	MT20	2.0	4.0	
F	TTWW-m	MT20	5.0	8.0	2.25 2.00
G	TMVW-l	MT20	4.0	4.0	2.00 1.75
I	TMBMR1-l	MT20	7.0	8.0	4.50
I	RT-l	MT20	3.0	8.0	
I	RT-l	MT20	3.0	6.0	
J	BMVW-w	MT20	2.0	4.0	
K	BS-l	MT20	3.0	6.0	
L	BMVW-l	MT20	4.0	4.0	
M	BMVW-w	MT20	4.0	9.0	
N	BMVW-l	MT20	4.0	4.0	
O	BS-l	MT20	3.0	6.0	
P	BMVW-l	MT20	5.0	6.0	2.50 2.25
Q	BMVW-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
I	1934	0	1934	0	0	5-8	5-8		
Q	2059	0	2059	0	0	5-8	5-8		

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
I	1388	898 / 0	0 / 0	0 / 0	0 / 0	470 / 0	0 / 0	0 / 0
Q	1453	967 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO	FROM	FR-TO	FROM
A-B	0 / 28	P-C	-253 / 13
B-C	-2881 / 0	C-N	-437 / 0
C-D	-2530 / 0	N-D	0 / 349
D-E	-2538 / 0	D-M	0 / 481
E-F	-2538 / 0	M-E	-597 / 0
F-G	-2579 / 0	G-M	0 / 384
G-H	-2225 / 0	H-F	0 / 417
H-S	-2225 / 0	S-G	-537 / 0
S-I	-2647 / 0	I-G	0 / 111
Q-B	-2009 / 0	B-P	0 / 2628
		P-S	0 / 1648
		R-H	-1850 / 0
Q-P	0 / 0		
P-O	0 / 2802		
O-N	0 / 2802		
N-M	0 / 2241		
M-L	0 / 2301		
L-K	0 / 2744		
K-J	0 / 2744		
J-R	0 / 2744		
R-I	0 / 1303		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.16")
ALLOWABLE DEFL.(RL) = L/360 (1.17")
CALCULATED VERT. DEFL.(RL) = L/999 (0.30")

CSI: TC=0.58/1.00 (B-C:1), BC=0.68/1.00 (J-R:1),
WB=0.59/1.00 (B-P:1), SS=0.31/1.00 (I-R:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1687 789 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (P) (INPUT = 0.90)
JSI METAL = 0.98 (I) (INPUT = 1.00)




Structural component only
DWG# T-2008086

JOB NAME 408317	TRUSS NAME T63	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:48 2020 Page 1
ID:DMCubINVR6TsFoe31v6I zns11-FrsYW9pcFT51IKXoCjrlL7jIRH11eyDH7eG4tZLZUr

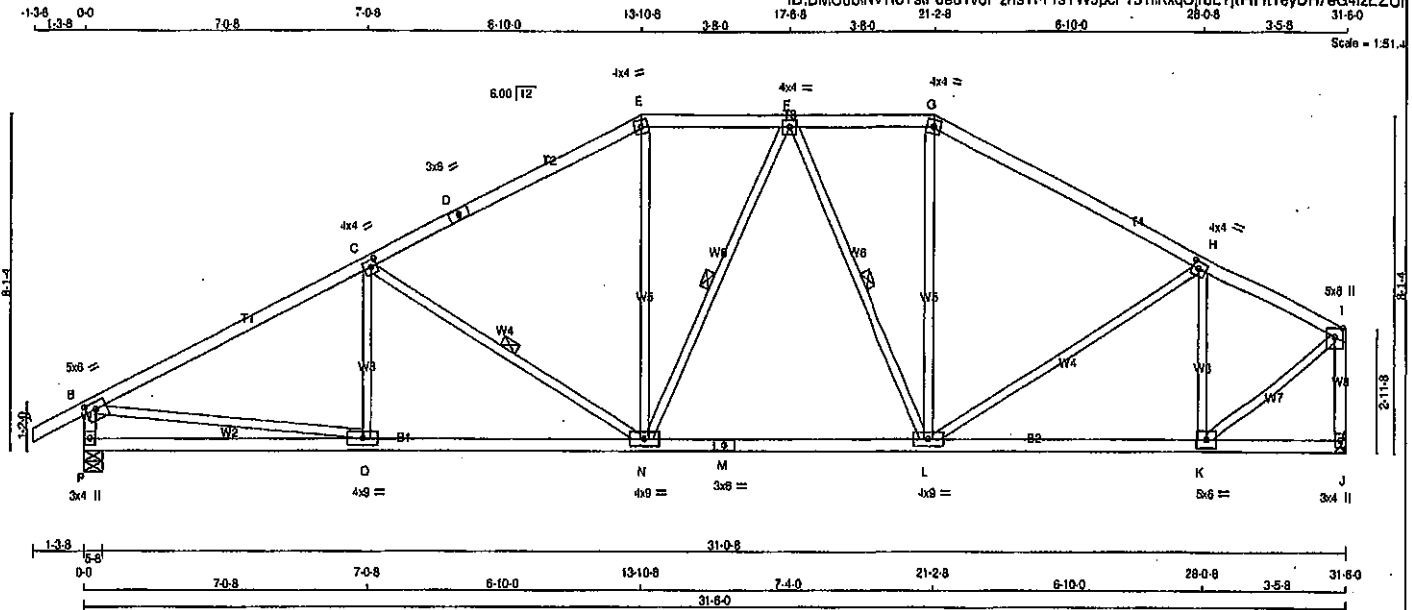

TOTAL WEIGHT = 135 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
P - B	2x4	DRY	No.2
J - I	2x4	DRY	No.2
P - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-1	MT20	5.0	6.0	2.00	2.75
C	TMWV-1	MT20	4.0	4.0	2.00	1.75
D	TS-1	MT20	3.0	6.0		
E	TTW-m	MT20	4.0	4.0		
F	TMWV-1	MT20	4.0	4.0		
G	TTW-m	MT20	4.0	4.0		
H	TMWV-1	MT20	4.0	4.0	2.00	1.75
I	TMWV-p	MT20	5.0	6.0	Edge	
J	BMV1-p	MT20	3.0	4.0		
K	BMWV-1	MT20	5.0	6.0		
L	BMWV-1	MT20	4.0	9.0		
M	BS-1	MT20	3.0	6.0		
N	BMWV-1	MT20	4.0	9.0		
O	BMWV-1	MT20	4.0	9.0		
P	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
P	1861	0	1861	0
J	1738	0	1738	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
P	1314	875 / 0	0 / 0	0 / 0	0 / 0	438 / 0	0 / 0	
J	1228	808 / 0	0 / 0	0 / 0	0 / 0	422 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.50 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, F-N, F-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED		MEMB.	MAX. FACTORED	FACTORED	
	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)		FORCE (LBS)	MAX. FACTORED	
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 28	-91.8	-91.8 0.12 (1)	10.00	C-C	-142 / 68	0.05 (1)
B-C	-2544 / 0	-91.8	-91.8 0.77 (1)	3.50	C-N	-880 / 0	0.31 (1)
C-D	-1971 / 0	-91.8	-91.8 0.67 (1)	4.01	N-E	0 / 497	0.11 (1)
D-E	-1971 / 0	-91.8	-91.8 0.67 (1)	4.01	N-F	-8 / 33	0.01 (4)
E-F	-1737 / 0	-91.8	-91.8 0.18 (1)	4.90	F-L	-438 / 0	0.22 (1)
F-G	-1558 / 0	-91.8	-91.8 0.17 (1)	5.12	L-G	0 / 387	0.09 (1)
G-H	-1763 / 0	-91.8	-91.8 0.59 (1)	4.35	L-H	0 / 275	0.08 (1)
H-I	-1426 / 0	-91.8	-91.8 0.43 (1)	4.93	K-H	-907 / 0	0.29 (1)
P-B	-1806 / 0	0.0	0.0 0.18 (1)	6.23	B-O	0 / 2323	0.52 (1)
J-I	-1718 / 0	0.0	0.0 0.27 (1)	6.35	K-I	0 / 1663	0.37 (1)
P-O	0 / 0	-18.5	-18.5 0.21 (4)	10.00			
O-N	0 / 2308	-18.5	-18.5 0.47 (1)	10.00			
N-M	0 / 1740	-18.5	-18.5 0.39 (1)	10.00			
M-L	0 / 1740	-18.5	-18.5 0.39 (1)	10.00			
L-K	0 / 1320	-18.5	-18.5 0.32 (1)	10.00			
K-J	0 / 0	-18.5	-18.5 0.12 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 26.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.05")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (1.05")
CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CSI: TO=0.77/1.00 (B-C:1), BC=0.47/1.00 (N-O:1), WB=0.52/1.00 (B-O:1), SS=0.28/1.00 (B-C:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1687
	788	1897	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (E) (INPUT = 0.90)
JSI METAL = 0.69 (B) (INPUT = 1.00)




Structural component only
DWG# T-2008067

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408317	T64	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Thu Apr 30 10:30:49 2020 Page 1

ID:DMCubINVR6TslFoe31v61_zns1Hj1QwVpEOnEuMuv7NvE48YX77qcMm5zMWnNgcCzLZUq

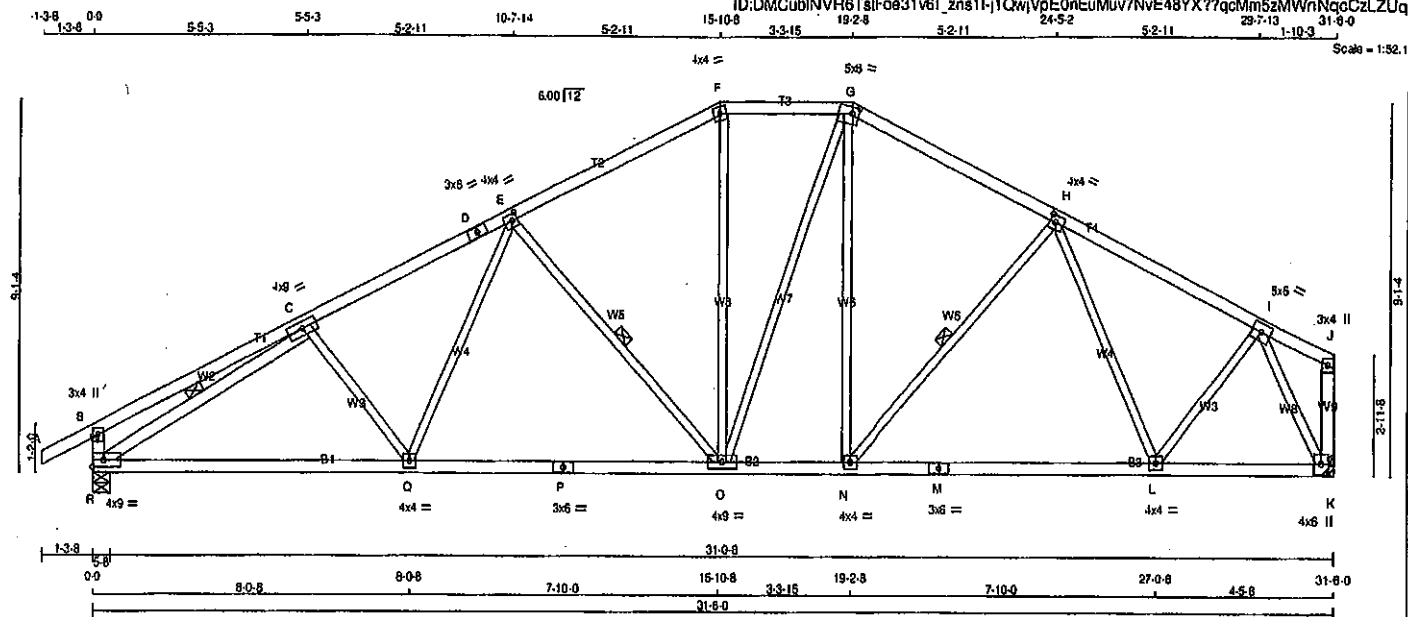

TOTAL WEIGHT = 2 X 142 = 285 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - J	2x4	DRY	No.2
K - B	2x4	DRY	No.2
K - J	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2
M - K	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2 SPF			
EXCEPT R - C 2x4 DRY No.2 SPF			
DRY: SEASONED LUMBER.			

PLATES (Table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMV-p	MT20	3.0	4.0
C	TMWW-1	MT20	4.0	9.0
D	TS-1	MT20	3.0	6.0
E	TMWW-1	MT20	4.0	4.0
F	TTW-m	MT20	4.0	4.0
G	TTWW-m	MT20	5.0	6.0
H	TMWW-1	MT20	4.0	4.0
I	TMWW-1	MT20	5.0	6.0
J	TMV-p	MT20	3.0	4.0
K	BMVW1-p	MT20	4.0	6.0
L, N, Q				
L	BMWW-1	MT20	4.0	4.0
M	BS-1	MT20	3.0	6.0
O	BMWW-1	MT20	4.0	9.0
P	BS-1	MT20	3.0	6.0
R	BMVW1-1	MT20	4.0	9.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
R	1881	0	1881	0	0
K	1736	0	1736	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT K. MINIMUM BEARING LENGTH AT JOINT K = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL		
R	1314	875/0	0/0	0/0	0/0	438.0	0/0		
K	1228	806/0	0/0	0/0	0/0	422.0	0/0		

BEARING MATERIAL TO BE 8PF NO.2 OR BETTER AT JOINT(S) R

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.14 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O, H-N, C-R.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/28	-91.8 -91.8	0.12 (1)	10.00	C-Q	-156/21	0.05 (1)
B-C	0/20	-91.8 -91.8	0.33 (1)	10.00	Q-E	0/318	0.07 (1)
C-D	-2389/0	-91.8 -91.8	0.36 (1)	4.14	E-O	-708/0	0.32 (1)
D-E	-2389/0	-91.8 -91.8	0.36 (1)	4.14	O-F	0/434	0.10 (1)
E-F	-1758/0	-91.8 -91.8	0.33 (1)	4.71	O-G	0/206	0.05 (1)
F-G	-1557/0	-91.8 -91.8	0.16 (1)	5.14	G-H	0/211	0.05 (1)
G-H	-1884/0	-91.8 -91.8	0.34 (1)	4.78	H-I	-140/0	0.08 (1)
H-I	-1501/0	-91.8 -91.8	0.33 (1)	5.01	I-L	-570/0	0.48 (1)
I-J	0/33	-91.8 -91.8	0.18 (1)	10.00	L-I	0/829	0.19 (1)
J-K	-324/0	0.0 0.0	0.03 (1)	7.81	R-C	-2678/0	0.54 (1)
K-J	-6/0	0.0 0.0	0.00 (1)	7.81	I-K	-1906/0	0.49 (1)
R-Q	0/2233	-18.5 -18.5	0.52 (1)	10.00			
Q-P	0/2014	-18.5 -18.5	0.49 (1)	10.00			
P-O	0/2014	-18.5 -18.5	0.48 (1)	10.00			
O-N	0/1487	-18.5 -18.5	0.33 (1)	10.00			
N-M	0/1575	-18.5 -18.5	0.36 (1)	10.00			
M-L	0/1575	-18.5 -18.5	0.36 (1)	10.00			
L-K	0/649	-18.5 -18.5	0.27 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.05")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (1.05")
CALCULATED VERT. DEFL.(TL) = L/999 (0.21")

CSI: TG=0.38/1.00 (C-E:1), BC=0.52/1.00 (C-R:1), WB=0.54/1.00 (C-H:1), SL=0.20/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1887 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.80 (C) (INPUT = 0.80)
JSI METAL= 0.73 (P) (INPUT = 1.00)




Structural component only
DWG# T-2008068

JOB NAME 408317	TRUSS NAME T65	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:50 2020 Page 1

ID:DMCubINVR6tstFoe31v6I_zns11-BD_Jxrqs5MI_2UJxdUhm47MEz?VYVWVR7N9ezLZUp

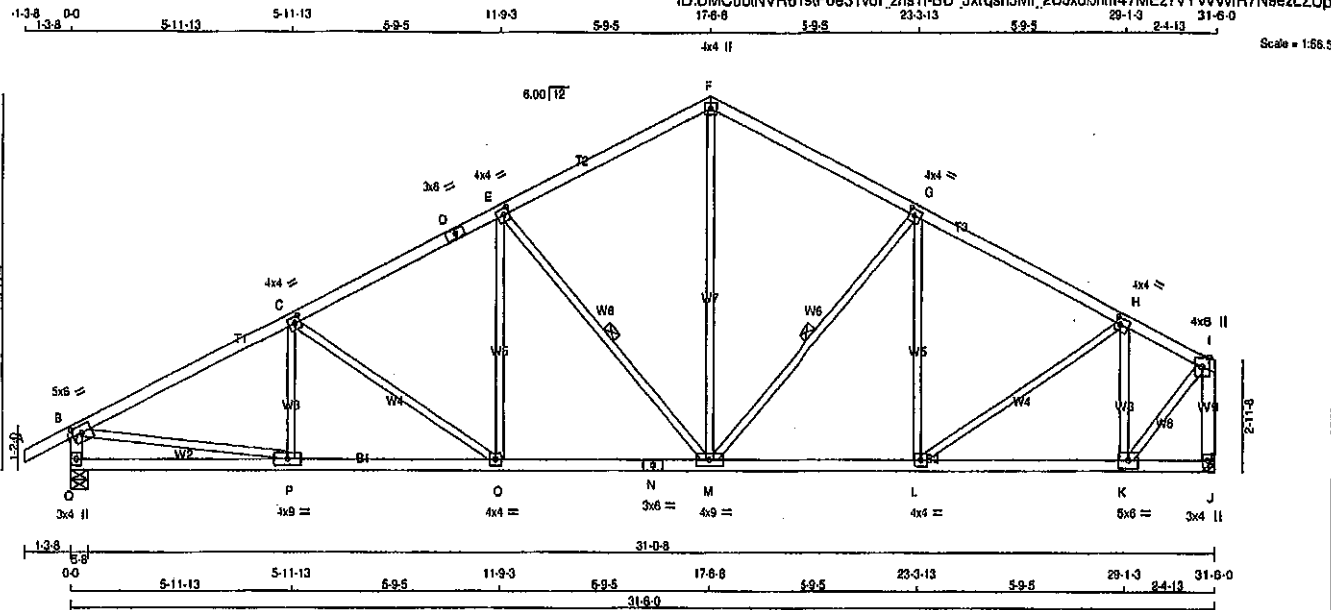

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
Q - B	2x4	DRY	No.2
J - I	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-I	MT20	5.0	5.0	2.25	2.75
C, E, G						
D	TMVW-I	MT20	4.0	4.0	2.00	1.75
L	TS-I	MT20	3.0	5.0		
F	TTW+p	MT20	4.0	4.0		
H	TMVW-I	MT20	4.0	4.0	2.00	1.50
I	TMVW+p	MT20	4.0	5.0	Edge	
J	BMV1+p	MT20	3.0	4.0		
K	BMVW-I	MT20	5.0	5.0		
L	BMVW-I	MT20	4.0	4.0		
M	BMVWW-I	MT20	4.0	5.0		
N	BS-I	MT20	3.0	5.0		
O	BMVW-I	MT20	4.0	4.0		
P	BMVW-I	MT20	4.0	5.0		
Q	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	HORIZ	BRG	IN-SX	BRG	IN-SX
Q	1861	0	1861	0	0	5-8	5-8		
J	1736	0	1736	0	0	MECHANICAL			

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS						
Q	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
Q	1314	875 / 0	0 / 0	0 / 0	0 / 0	438 / 0	0 / 0		
J	1228	808 / 0	0 / 0	0 / 0	0 / 0	422 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-M, G-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED (CSI (LC))	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED (CSI (LC))	
FR-TO		FROM TO		FR-TO			
A-B	0 28	-91.8 -91.8 0.12 (1)	10.00	P-C	-209 25	0.06 (1)	
B-C	-2522 / 0	-91.8 -91.8 0.52 (1)	3.88	C-O	-393 / 0	0.36 (1)	
C-D	-2179 / 0	-91.8 -91.8 0.41 (1)	4.24	O-E	0 322	0.07 (1)	
D-E	-2179 / 0	-91.8 -91.8 0.41 (1)	4.24	E-M	-832 / 0	0.45 (1)	
E-F	-1596 / 0	-91.8 -91.8 0.40 (1)	4.80	M-F	0 985	0.22 (1)	
F-G	-1599 / 0	-91.8 -91.8 0.41 (1)	4.78	G-H	-320 / 0	0.17 (1)	
G-H	-1794 / 0	-91.8 -91.8 0.41 (1)	4.58	H-I	-269 / 0	0.23 (1)	
H-I	-1145 / 0	-91.8 -91.8 0.18 (1)	5.74	I-H	0 678	0.15 (1)	
Q-B	-1813 / 0	0.0 0.0 0.18 (1)	6.21	K-H	-1072 / 0	0.28 (1)	
J-I	-1728 / 0	0.0 0.0 0.27 (1)	8.33	B-P	0 2289	0.52 (1)	
				K-I	0 1565	0.35 (1)	
Q-P	0 / 0	-18.5 -18.5 0.14 (4)	10.00				
P-O	0 2278	-18.5 -18.5 0.43 (1)	10.00				
O-N	0 1949	-18.5 -18.5 0.39 (1)	10.00				
N-M	0 1949	-18.5 -18.5 0.39 (1)	10.00				
M-L	0 1616	-18.5 -18.5 0.33 (1)	10.00				
L-K	0 1051	-18.5 -18.5 0.23 (1)	10.00				
K-J	0 0	-18.5 -18.5 0.09 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/G

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 066-09, CSA 068-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (1.05")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/380 (1.05")
CALCULATED VERT. DEFL.(TL) = L/999 (0.19")

CSI: TC=0.52/1.00 (B-C:1), BC=0.43/1.00 (C-P:1), WB=0.52/1.00 (B-P:1), SI=0.23/1.00 (B-C:1)

DOL LUMBER-1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (P) (INPUT = 0.90)
JSI METAL= 0.67 (B) (INPUT = 1.00)




Structural component only
DWG# T-2008069

JOB NAME 408317	TRUSS NAME T66	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 20 2019 MITek Industries, Inc. Thu Apr 30 10:50:52 2020 Page 1

ID:DMCubiNVR6TstFos31v6l_zng11-IQVh8BrUYUccC3WVKGYDzdLleEZEy3fz5xh3zLZUo

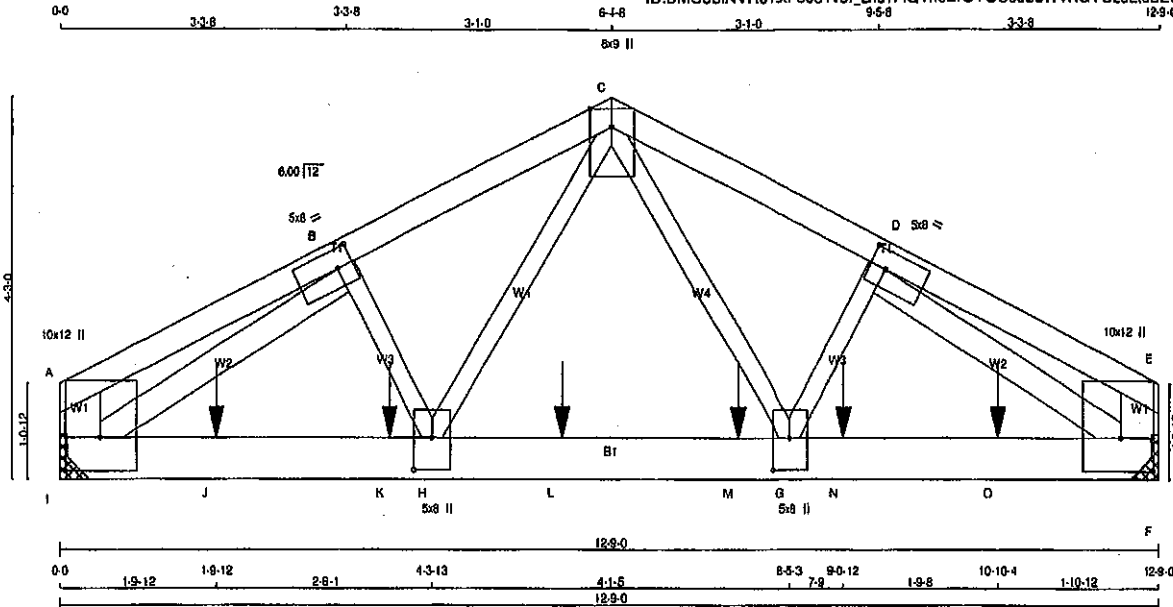

Scale = 1:23.7

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
I - A	2x8	DRY	No.2
F - E	2x8	DRY	No.2
I - F	2x6	DRY	1650F 1.5E
ALL WEBS 2x3 DRY No.2 SPF			
EXCEPT			
I - B	2x4	DRY	No.2
D - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 1	12	TOP
C - E 1	12	TOP
I - A 2	12	TOP
F - E 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
I - F 2	12	SIDE (0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	
2x4 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
I	5734	0	5734	0
F	5980	0	5980	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I.F. MINIMUM BEARING LENGTH AT JOINT I = 4-0, JOINT F = 4-0.

UNFACTORED REACTIONS

JT	1ST LOASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	4050	2688 / 0	0 / 0	0 / 0	0 / 0	0 / 0	1384 / 0	0 / 0
F	4224	2802 / 0	0 / 0	0 / 0	0 / 0	0 / 0	1422 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.19 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO				FR-TO			
A-B	-3 / 0	-91.8	-91.8 0.09 (1)	10.00	C-G	0 / 4282	0.53 (1)
B-C	-7793 / 0	-91.8	-91.8 0.31 (1)	3.31	G-D	0 / 1052	0.13 (1)
C-D	-8218 / 0	-91.8	-91.8 0.34 (1)	3.19	H-C	0 / 3477	0.43 (1)
D-E	-4 / 0	-91.8	-91.8 0.10 (1)	10.00	B-H	0 / 978	0.12 (1)
I-A	-150 / 0	0.0	0.0 0.01 (1)	7.61	I-B	-8011 / 0	0.72 (1)
F-E	-184 / 0	0.0	0.0 0.01 (1)	7.61	D-F	-8439 / 0	0.76 (1)
I-J	0 / 6530	-18.5	-18.5 0.69 (1)	10.00			
J-K	0 / 6530	-18.5	-18.5 0.69 (1)	10.00			
K-H	0 / 6530	-18.5	-18.5 0.69 (1)	10.00			
H-L	0 / 5336	-18.5	-18.5 0.57 (1)	10.00			
L-M	0 / 5336	-18.5	-18.5 0.57 (1)	10.00			
M-G	0 / 5336	-18.5	-18.5 0.57 (1)	10.00			
G-N	0 / 6878	-18.5	-18.5 0.72 (1)	10.00			
N-O	0 / 6878	-18.5	-18.5 0.72 (1)	10.00			
O-F	0 / 6878	-18.5	-18.5 0.72 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
J	1-9-12	-1718	-1718	---	BACK	VERT	TOTAL	---	C1
K	3-9-12	-1718	-1718	---	BACK	VERT	TOTAL	---	C1
L	5-9-12	-1718	-1718	---	BACK	VERT	TOTAL	---	C1
M	7-9-12	-1718	-1718	---	BACK	VERT	TOTAL	---	C1
N	9-0-12	-1718	-1718	---	BACK	VERT	TOTAL	---	C1
O	10-10-4	-1718	-1718	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.43")
CALCULATED VERT. DEFL. (LL) = L/999 (0.07")
ALLOWABLE DEFL. (TL) = L/360 (0.43")
CALCULATED VERT. DEFL. (TL) = L/999 (0.13")

CSI: TC=0.34/1.00 (C-D:1), BC=0.72/1.00 (F-G:1), WB=0.75/1.00 (D-F:1), CSI=0.69/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (D) (INPUT = 0.90)
JSI METAL= 0.78 (D) (INPUT = 1.00)



Structural component only
DWG# T-2008070


CONTINUED ON PAGE 2

JOB NAME 408317	TRUSS NAME T66	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310.8 Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:50:52 2020 Page 2	ID:DMCubNVR6TsIFoe31v6l_zns1I-7c63MXs6JicTDM6i22nmB9Wd2aozPjpCkUDXzLZUn

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A, E, F, I					
A	TMBMW1*+pMT20	10.0	12.0	4.50	4.75
B	TMWW+I MT20	5.0	8.0	2.50	2.25
C	TTWW+p MT20	6.0	9.0	Edge	
D	TMWW+I MT20	5.0	8.0	2.50	2.25
E	TMBMW1*+pMT20	10.0	12.0	4.50	4.75
G	BMWW+I MT20	5.0	8.0	4.25	2.50
H	BMWW+I MT20	5.0	8.0	4.25	2.50


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

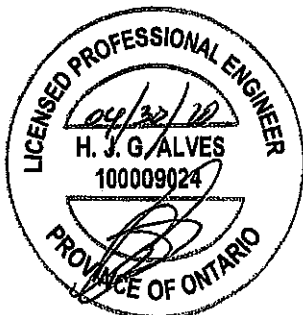

Structural component only
DWG# T-2008070 72

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408317	T67SX	1	1	GREEN PARK HOMES	
Tgmarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:54 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-47DpnCimrJsBTgo5ASqFrcFvDrObRQ75g25bIPzLZU

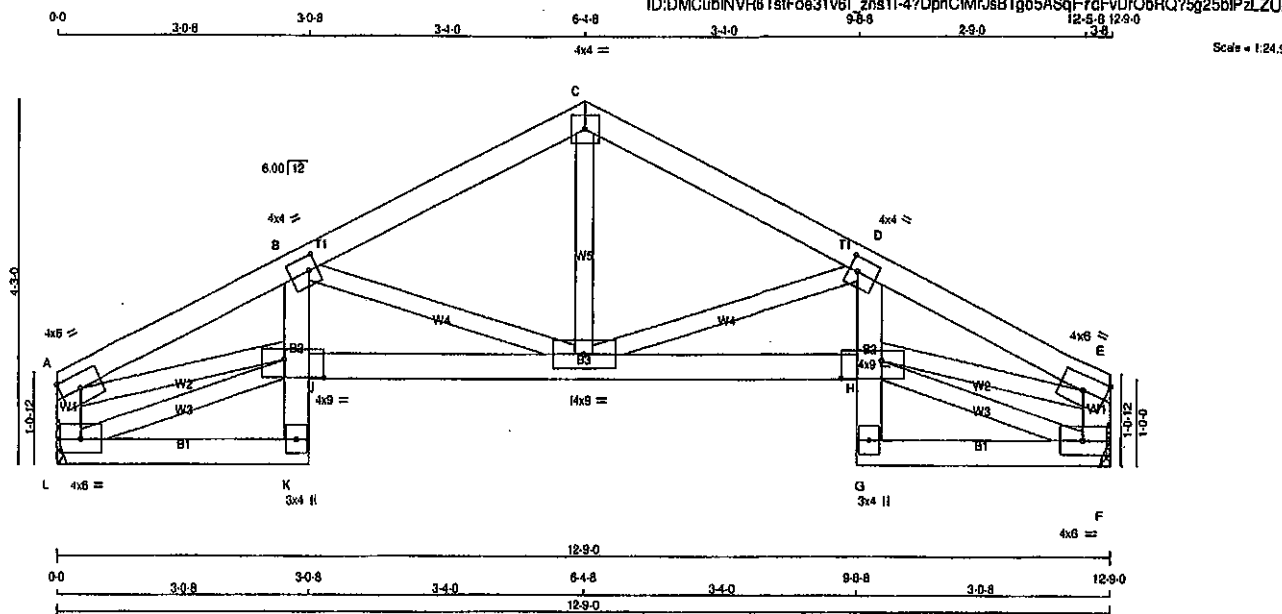

TOTAL WEIGHT = 53 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
L - A	2x4	DRY	No.2
F - E	2x4	DRY	No.2
L - K	2x4	DRY	No.2
K - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
G - D	2x4	DRY	No.2
G - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT
DRY: SEASONED LUMBER.

PLATES (tables in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMWV-1	MT20	4.0	8.0 Edge
B	TMWV-1	MT20	4.0	4.0 2.00 1.25
C	TTW-p	MT20	4.0	4.0
D	TMWV-1	MT20	4.0	4.0 2.00 1.25
E	TMWV-1	MT20	4.0	8.0 Edge
F	BMVW1-1	MT20	4.0	8.0
G	BMV-p	MT20	3.0	4.0
H	BMVWW-1	MT20	4.0	9.0 2.50 5.75
I	BMVWW-1	MT20	4.0	9.0
J	BMVWW-1	MT20	4.0	9.0 2.50 5.75
K	BMV-p	MT20	3.0	4.0
L	BMVW1-1	MT20	4.0	8.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECRD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
L	703	0	703	0	0
F	703	0	703	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT L, F. MINIMUM BEARING LENGTH AT JOINT L = 1-8, JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LOSE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	497	326 / 0	0 / 0	0 / 0	0 / 0	0 / 0	171 / 0	0 / 0
F	497	326 / 0	0 / 0	0 / 0	0 / 0	0 / 0	171 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.35 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	-1445 / 0	B-1	-834 / 0
B-C	-871 / 0	I-C	0 / 483
C-D	-871 / 0	I-D	-83 / 0
D-E	-1444 / 0	L-J	-88 / 0
L-A	-848 / 0	A-J	0 / 1307
F-E	-848 / 0	H-F	-88 / 0
L-K	0 / 81	H-E	0 / 1308
K-J	0 / 30		
J-B	0 / 135		
J-I	0 / 1370		
I-H	0 / 1369		
G-H	0 / 30		
H-D	0 / 134		
G-F	0 / 81		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.43")
CALCULATED VERT. DEFL.(LL) = $U/999$ (0.04")
ALLOWABLE DEFL.(TL) = $L/360$ (0.43")
CALCULATED VERT. DEFL.(TL) = $U/999$ (0.07")

CSI: TC=0.14/1.00 (C-D:1), BC=0.25/1.00 (I-J:1), WB=0.29/1.00 (A-J:1), SS=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.78 (A) (INPUT = 0.90)
JSI METAL= 0.38 (E) (INPUT = 1.00)




Structural component only
DWG# T-2008072

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408317	T68	1	2	TRUSS DESC.		

Temarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:50:54 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-47DpnCmRJsBTgo5ASqFrcFuGkHpRlt5g25bIPzLZU

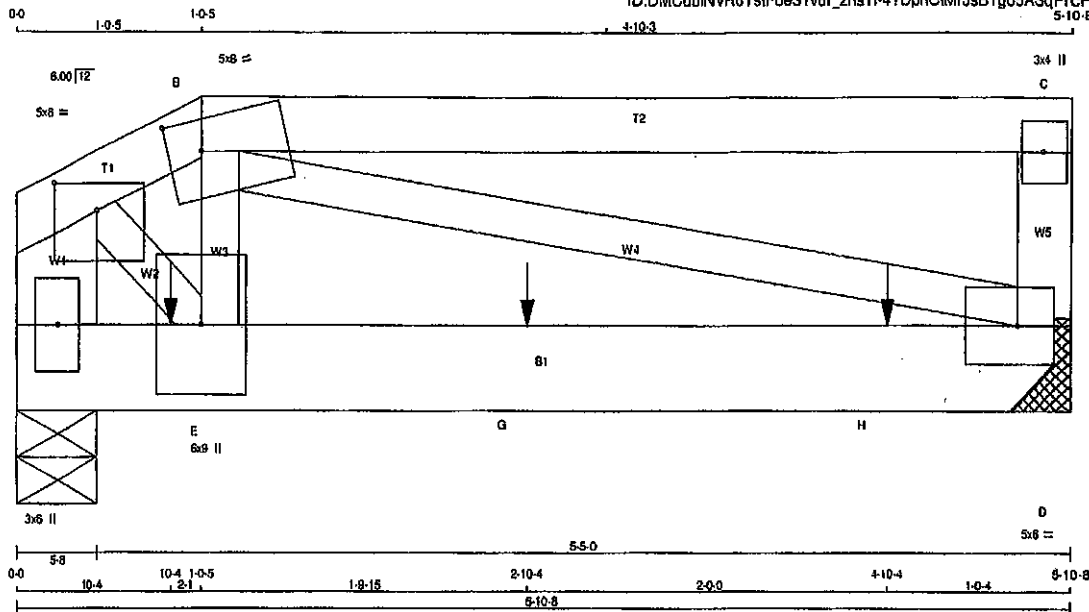

TOTAL WEIGHT = 2 X 25 = 49 lb

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF
B - C	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
F - A	2x6	DRY	No.2	SPF
F - D	2x6	DRY	1650F 1.5E	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - B	12	TOP
B - C	12	TOP
C - D	12	TOP
F - A	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D	8	SIDE (427.3)
WEBS : (0.122"x3") SPIRAL NAILS		
E - B	2	SIDE (89.7)
2x3	1	6

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UOL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-p	MT20	5.0	6.0	1.75	3.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED	GROSS REACTION		MAXIMUM FACTORED	INPUT	RECORD	
		DOWN	HORIZ	DOWN	HORIZ	UPLIFT	IN-SX
JT	VERT						
D	3340	0	3340	0	0	MECHANICAL	
F	3319	0	3319	0	0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

JT	COMBINED	MAX / MIN. COMPONENT REACTIONS					
		1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD
D	2358	1580 / 0	0 / 0	0 / 0	0 / 0	775 / 0	0 / 0
F	2341	1570 / 0	0 / 0	0 / 0	0 / 0	771 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.57 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO	CS (LC)	UNBRAC LENGTH	FR-TO		
A-B	-4328 / 0	-91.8	-91.8 0.07 (1)	4.57	E-B	0 / 2791	0.35 (1)
B-C	0 / 0	-91.8	-91.8 0.20 (1)	10.00	B-D	-4223 / 0	0.81 (1)
C-D	-222 / 0	0.0	0.0 0.01 (1)	7.81	A-E	0 / 4673	0.58 (1)
F-A	-4647 / 0	0.0	0.0 0.16 (1)	6.70			
F-E	0 / 0	-18.5	-18.5 0.39 (1)	10.00			
E-G	0 / 4080	-18.5	-18.5 0.69 (1)	10.00			
G-H	0 / 4080	-18.5	-18.5 0.69 (1)	10.00			
H-D	0 / 4080	-18.5	-18.5 0.69 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	10-4	-2005	-2005	---	FRONT	VERT	TOTAL	---	C1
G	2-10-4	-2003	-2003	---	FRONT	VERT	TOTAL	---	C1
H	4-10-4	-2003	-2003	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/547 (0.13")

CSI: TC=0.20/1.00 (B-C:1), BC=0.69/1.00 (D-E:1), WB=0.81/1.00 (B-D:1), SS=0.69/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 768 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.81 (E) (INPUT = 1.00)




Structural component only
DWG# T-2008073

CONTINUED ON PAGE 2

JOB NAME 408317	TRUSS NAME T68	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MTak Industries, Inc. Thu Apr 30 10:50:54 2020 Page 2 ID:DMCubINVR6TstFoe31v8I zns1L-47DpnCImJsBTgo5ASqFrcFuG-HoRli5g25bIPzLZUJ			

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TTWW-m	MT20	5.0	8.0	2.00	2.25
C	TMV+p	MT20	3.0	4.0		
D	BMVW1-t	MT20	5.0	6.0	2.50	2.50
E	BMVW+l	MT20	6.0	9.0		
F	BMV1+p	MT20	3.0	6.0		

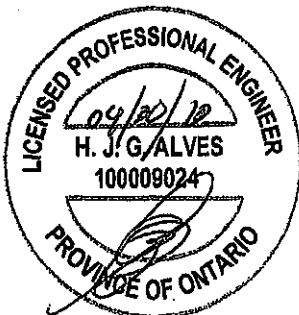


Structural component only
DWG# T-2008073

JOB NAME 408317	TRUSS NAME T69	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITAK Industries, Inc. Thu Apr 30 10:50:58 2020 Page 1
ID:DMCubINVR6TstFoe31v61_zns11-ONLaBuvdNx6v1zXTHisw1K5i1nviXO7MaimLzLZUj

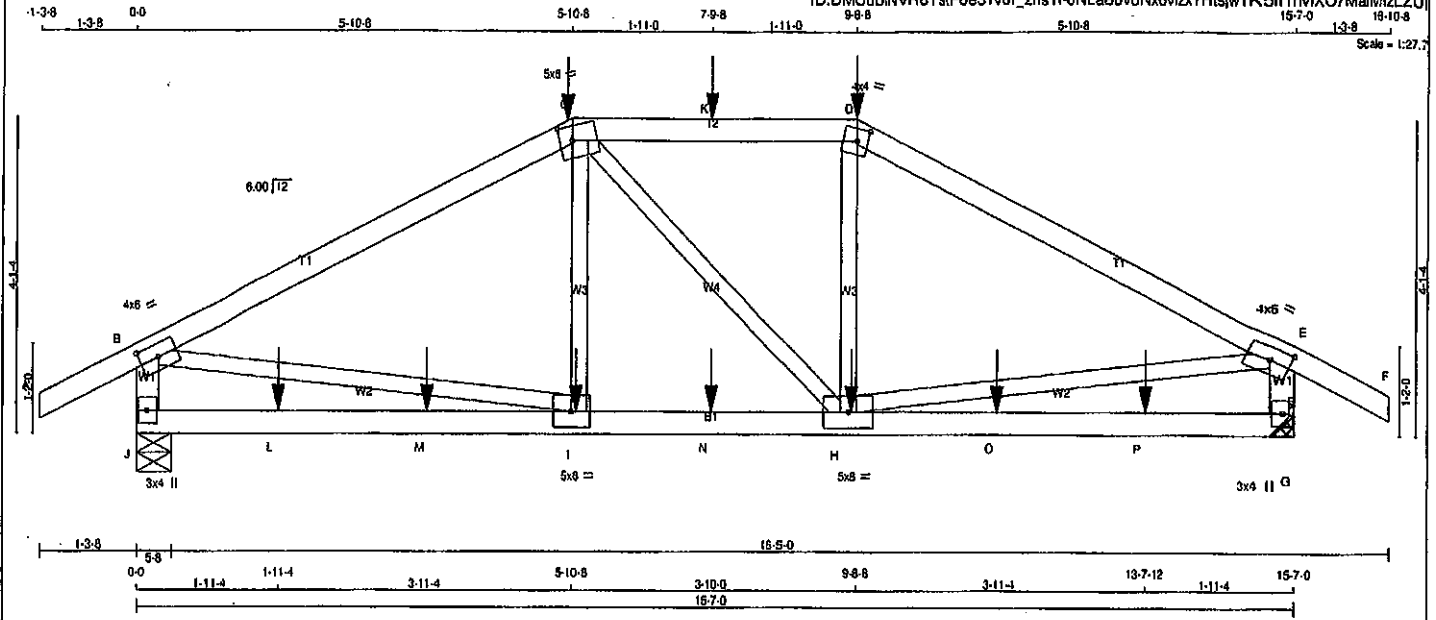

TOTAL WEIGHT = 61 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
J - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
J - G	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-1	MT20	4.0	8.0	2.00	3.00
C TTWW-m	MT20	5.0	8.0	2.25	2.00
D TTWW-m	MT20	4.0	4.0	2.00	1.75
E TMVW-1	MT20	4.0	8.0	2.00	3.00
G BMV1-p	MT20	3.0	4.0		
H BMVWW-1	MT20	5.0	8.0		
I BMVWW-1	MT20	5.0	8.0		
J BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
J	1544	0	1544	0	5-8
G	1543	0	1543	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	1091	722/0	0/0	0/0	0/0	0/0	389/0	0/0	0/0
G	1090	722/0	0/0	0/0	0/0	0/0	389/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.85 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED	MEMB.	MAX. FACTORED
FR-TO	FORCE (LBS)	FR-TO	FORCE (LBS)
A-B	0/28	I-C	-78/105
B-C	-1873/0	C-H	0/3
C-K	-1674/0	H-D	-73/107
K-D	-1674/0	D-E	0/1694
D-E	-1876/0	E-F	0/28
E-F	0/28	F-G	-1473/0
F-G	-1473/0	G-H	0/0
G-H	0/0	H-I	0/0
H-I	0/0	I-J	0/0
I-J	0/0	J-K	0/0
J-K	0/0	K-L	0/0
K-L	0/0	L-M	0/0
L-M	0/0	M-N	0/0
M-N	0/0	N-O	0/0
N-O	0/0	O-P	0/0
O-P	0/0	P-Q	0/0
P-Q	0/0	Q-R	0/0
Q-R	0/0	R-S	0/0
R-S	0/0	S-T	0/0
S-T	0/0	T-U	0/0
T-U	0/0	U-V	0/0
U-V	0/0	V-W	0/0
V-W	0/0	W-X	0/0
W-X	0/0	X-Y	0/0
X-Y	0/0	Y-Z	0/0
Y-Z	0/0	Z-A	0/0

MEMB.	MAX. FACTORED	FORCE (LBS)	CS (LC)	UNBRACED	FR-TO	FR-TO	FR-TO
A-B	0/28	-31.8	-31.8	0.13 (1)	10.00	I-C	-78/105
B-C	-1873/0	-31.8	-31.8	0.78 (1)	3.85	C-H	0/3
C-K	-1674/0	-31.8	-31.8	0.47 (1)	4.48	H-D	-73/107
K-D	-1674/0	-31.8	-31.8	0.47 (1)	4.48	D-E	0/1694
D-E	-1876/0	-31.8	-31.8	0.78 (1)	3.85	E-F	0/28
E-F	0/28	-31.8	-31.8	0.13 (1)	10.00	F-G	-1473/0
F-G	-1473/0	0.0	0.0	0.16 (1)	6.71	G-H	0/0
G-H	-1473/0	0.0	0.0	0.16 (1)	6.71	H-I	0/0
H-I	0/0	-18.5	-18.5	0.28 (4)	10.00	I-J	0/0
I-J	0/0	-18.5	-18.5	0.28 (4)	10.00	J-K	0/0
J-K	0/0	-18.5	-18.5	0.28 (4)	10.00	K-L	0/0
K-L	0/0	-18.5	-18.5	0.40 (1)	10.00	L-M	0/0
L-M	0/0	-18.5	-18.5	0.40 (1)	10.00	M-N	0/0
M-N	0/0	-18.5	-18.5	0.40 (1)	10.00	N-O	0/0
N-O	0/0	-18.5	-18.5	0.28 (4)	10.00	O-P	0/0
O-P	0/0	-18.5	-18.5	0.28 (4)	10.00	P-Q	0/0
P-Q	0/0	-18.5	-18.5	0.28 (4)	10.00	Q-R	0/0
Q-R	0/0	-18.5	-18.5	0.28 (4)	10.00	R-S	0/0
R-S	0/0	-18.5	-18.5	0.28 (4)	10.00	S-T	0/0
S-T	0/0	-18.5	-18.5	0.28 (4)	10.00	T-U	0/0
T-U	0/0	-18.5	-18.5	0.28 (4)	10.00	U-V	0/0
U-V	0/0	-18.5	-18.5	0.28 (4)	10.00	V-W	0/0
V-W	0/0	-18.5	-18.5	0.28 (4)	10.00	W-X	0/0
W-X	0/0	-18.5	-18.5	0.28 (4)	10.00	X-Y	0/0
X-Y	0/0	-18.5	-18.5	0.28 (4)	10.00	Y-Z	0/0
Y-Z	0/0	-18.5	-18.5	0.28 (4)	10.00	Z-A	0/0

FACTORED CONCENTRATED LOADS (LBS)		LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-414	-414	---	---	FRONT	VERT	TOTAL	---	C1
D	9-8-8	-414	-414	---	---	FRONT	VERT	TOTAL	---	C1
H	9-7-12	-28	-28	---	---	FRONT	VERT	TOTAL	---	C1
I	5-11-4	-26	-26	---	---	FRONT	VERT	TOTAL	---	C1
K	7-9-8	-110	-110	---	---	FRONT	VERT	TOTAL	---	C1
L	1-11-4	-25	-25	---	---	FRONT	VERT	TOTAL	---	C1
M	3-11-4	-26	-26	---	---	FRONT	VERT	TOTAL	---	C1
N	7-9-8	-26	-26	---	---	FRONT	VERT	TOTAL	---	C1
O	11-7-12	-28	-28	---	---	FRONT	VERT	TOTAL	---	C1
P	13-7-12	-25	-25	---	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.52")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL) = L/360 (0.52")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TC=0.78/1.00 (D-E:1), BC=0.40/1.00 (H-I:1),
WB=0.42/1.00 (E-H:1), SS=0.21/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1887 788	1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (E) (INPUT = 0.80)
JSI METAL = 0.51 (E) (INPUT = 1.00)




Structural component only
DWG# T-2008074

JOB NAME 408317	TRUSS NAME T70	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:57 2020 Page 1

ID:DMCubINVR8tstFoe31v6l_zns1l-UavyPEwF8EEemK7WibNyTEiOK3M9egYM0JFukzLZU

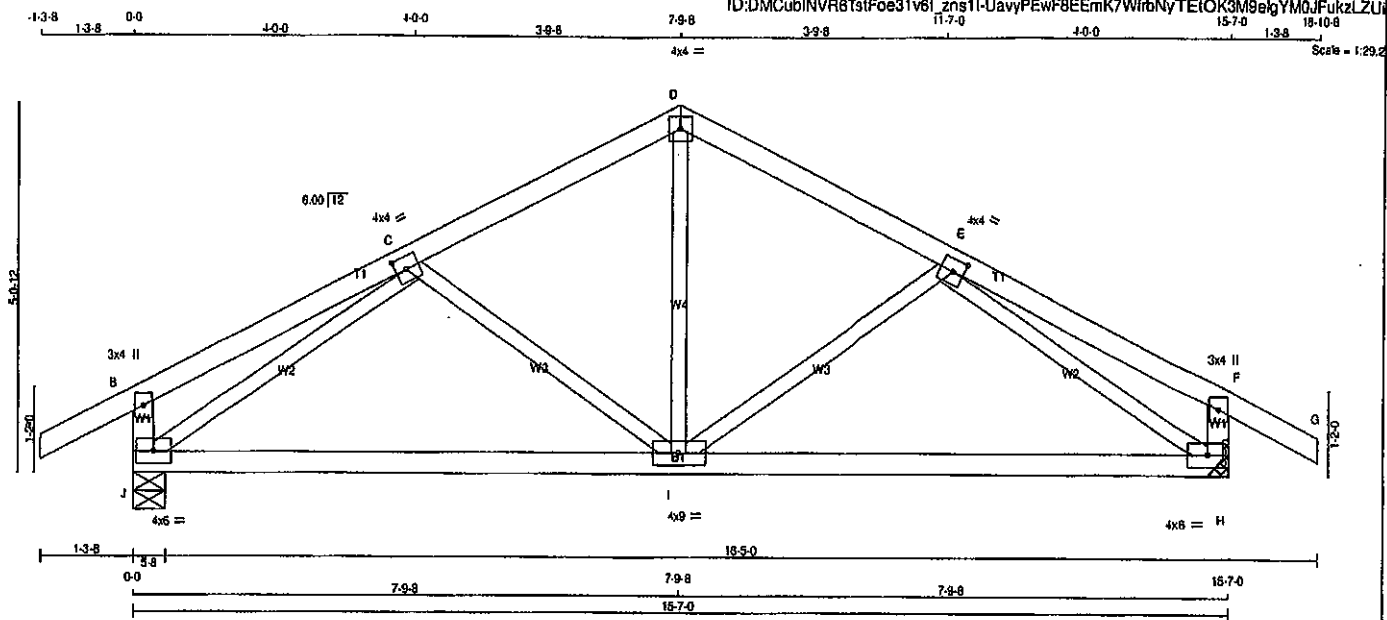

TOTAL WEIGHT = 61 lb

LUMBER			
N.L.G.A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMWW-1	MT20	4.0	4.0	2.00	1.75
D TTW-p	MT20	4.0	4.0		
E TMWW-1	MT20	4.0	4.0	2.00	1.75
F TMV+p	MT20	3.0	4.0		
H BMVW1-1	MT20	4.0	6.0		
I BMVWW-1	MT20	4.0	9.0		
J BMVW1-1	MT20	4.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
J	984	0	984	0
H	984	0	984	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-B.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	693	468/0	0/0	0/0	0/0	0/0	225/0	0/0
H	693	468/0	0/0	0/0	0/0	0/0	225/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO				FR-TO			
A-B	0/28	-91.8	-91.8 0.12 (1)	I-D	0/455	0.10 (1)	
B-C	0/18	-91.8	-91.8 0.21 (1)	I-E	-237/0	0.09 (1)	
C-D	-835/0	-91.8	-91.8 0.17 (1)	G-I	-237/0	0.09 (1)	
D-E	-835/0	-91.8	-91.8 0.17 (1)	J-C	-1137/0	0.43 (1)	
E-F	0/18	-91.8	-91.8 0.21 (1)	E-H	-1137/0	0.43 (1)	
F-G	0/28	-91.8	-91.8 0.12 (1)				
J-B	-284/0	0.0	0.0 0.03 (1)				
H-F	-284/0	0.0	0.0 0.03 (1)				
J-I	0/223	-18.5	-18.5 0.39 (4)				
I-H	0/223	-18.5	-18.5 0.39 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.52")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.02")
ALLOWABLE DEFL.(TL) = $L/360$ (0.52")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.10")

CSI: TC=0.21/1.00 (E-F:1), BC=0.39/1.00 (I-J:4), WB=0.43/1.00 (C-J:1), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1687
	1687	788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.81 (E) (INPUT = 0.80)
JSI METAL = 0.38 (E) (INPUT = 1.00)



Structural component only
DWG# T-2008075

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408317	T71	2	1	GREEN PARK HOMES	
TRUSS DESC.					
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 10:50:58 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns11-ymTKcawtvYMDxH5sPluB7SPa7TkVNEGhag3oRAzLZUh

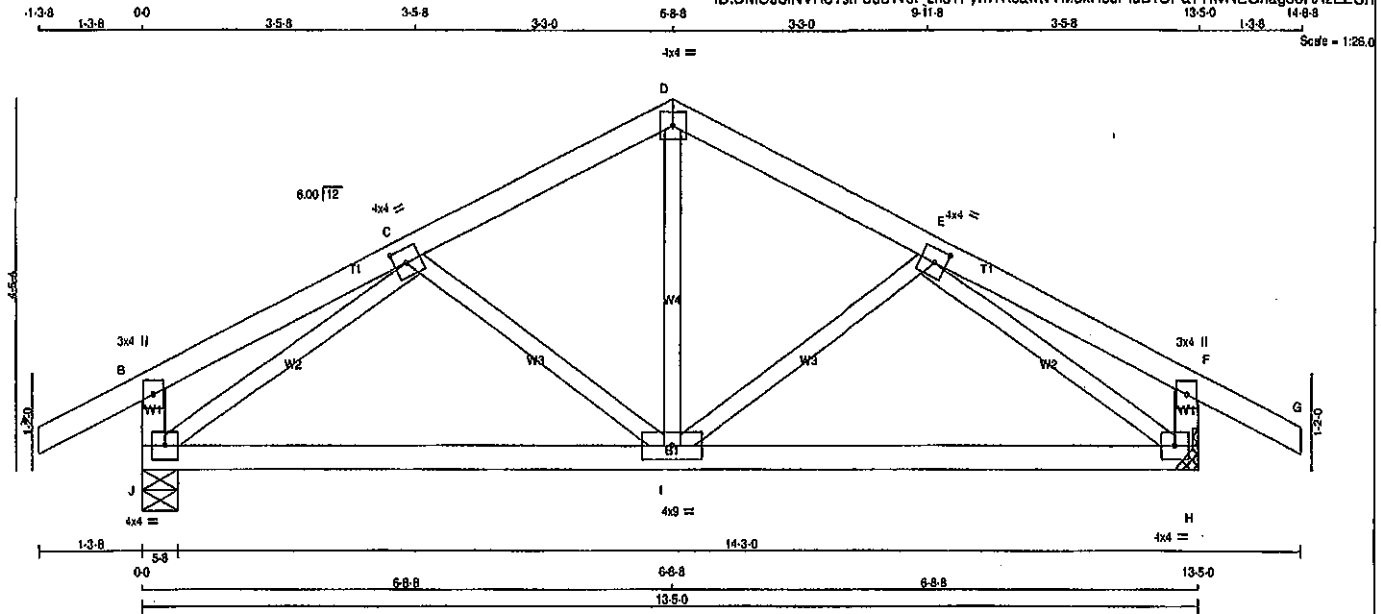

TOTAL WEIGHT = 2 X 53 = 107 lb
(MIF)

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4 DRY No.2	SPF			
D - G	2x4 DRY No.2	SPF			
J - B	2x4 DRY No.2	SPF			
H - F	2x4 DRY No.2	SPF			
J - H	2x4 DRY No.2	SPF			
ALL WEBS EXCEPT	2x3 DRY No.2	SPF			

DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE	PLATES			
B	TMV+p	MT20	3.0	4.0
C	TMWW-I	MT20	4.0	4.0
D	TTW-p	MT20	4.0	4.0
E	TMWW-I	MT20	4.0	4.0
F	TMV+p	MT20	3.0	4.0
H	BMWW-I	MT20	4.0	4.0
I	BMWW-I	MT20	4.0	4.0
J	BMWW-I	MT20	4.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	HORZ	DOWN	HORZ	UPLIFT
J	864	0	864	0
H	864	0	864	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

1ST LOASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT COMBINED							
J	609	413/0	0/0	0/0	0/0	196/0	0/0
H	609	413/0	0/0	0/0	0/0	196/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (L/C)	UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (L/C)
FR-TO		FROM TO			FR-TO		
A-B	0/28	-91.8	-91.8	0.12 (1)	10.00	I-D	0/371
B-C	0/15	-91.8	-91.8	0.15 (1)	10.00	I-E	-181/0
C-D	-698/0	-91.8	-91.8	0.12 (1)	8.28	C-I	-181/0
D-E	-698/0	-91.8	-91.8	0.12 (1)	6.28	J-C	-946/0
E-F	0/15	-91.8	-91.8	0.15 (1)	10.00	E-H	-946/0
F-G	0/28	-91.8	-91.8	0.12 (1)	10.00		
J-B	-246/0	0.0	0.0	0.02 (1)	7.81		
H-F	-246/0	0.0	0.0	0.02 (1)	7.81		
J-I	0/755	-18.5	-18.5	0.29 (4)	10.00		
I-H	0/755	-18.5	-18.5	0.29 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.45")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.45")
CALCULATED VERT. DEFL. (TL) = L/999 (0.08")

CSI: TC=0.15/1.00 (E-F:1), BC=0.29/1.00 (H-I:4), WB=0.28/1.00 (E-H:1), SS=0.13/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.85 (J) (INPUT = 0.90)
JSI METAL= 0.32 (E) (INPUT = 1.00)




Structural component only
DWG# T-2008076

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408317	T72S	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Thu Apr 30 10:50:59 2020 Page 1
ID:DMCubINVR6TstFoe31v8l_zns11-Qy1iqwxVgsUJZRG2z0PQYy0s3j6frpKoMzdzLZUg

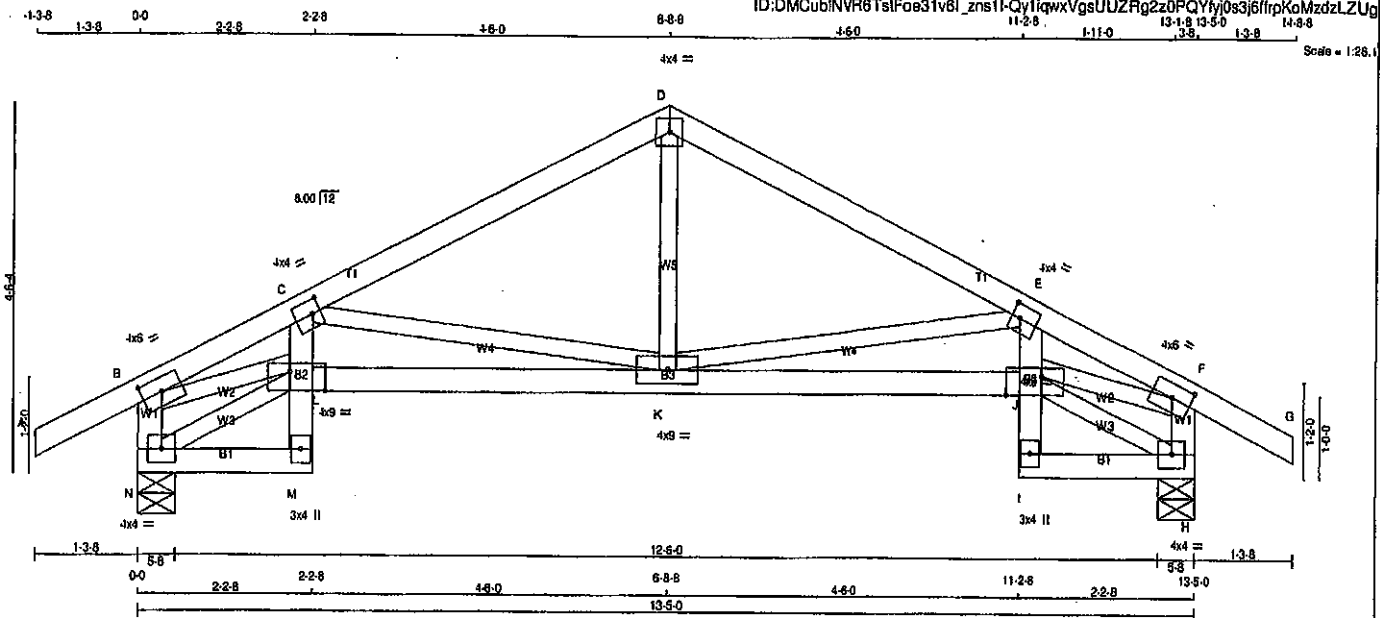

TOTAL WEIGHT = 2 X 57 = 114 lb
[M/F]

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
N - B	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
N - M	2x4	DRY	No.2	SPF	
M - C	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
I - E	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	8.0	2.00	3.00
C	TMVW-1	MT20	4.0	4.0	2.00	1.25
D	TYW-p	MT20	4.0	4.0		
E	TMVW-1	MT20	4.0	4.0	2.00	1.25
F	TMVW-1	MT20	4.0	8.0	2.00	3.00
H	BMVW-1	MT20	4.0	4.0		
I	BMVW-1	MT20	4.0	4.0		
J	BMVW-1	MT20	4.0	9.0	2.75	5.50
K	BMVW-1	MT20	4.0	9.0		
L	BMVW-1	MT20	4.0	9.0	2.75	5.50
M	BMVW-1	MT20	4.0	4.0		
N	BMVW-1	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
N	884	0	884	0
H	884	0	884	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
N	609	413 / 0	0 / 0	0 / 0	0 / 0	198 / 0	0 / 0	0 / 0
H	609	413 / 0	0 / 0	0 / 0	0 / 0	198 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.07 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0.28	-91.8	-91.8 0.12 (1)	10.00	K-D	0.412	0.09 (1)
B-C	-1616 / 0	-91.8	-91.8 0.15 (1)	5.07	K-E	-812 / 0	0.30 (1)
C-D	-892 / 0	-91.8	-91.8 0.28 (1)	8.18	C-K	-812 / 0	0.30 (1)
D-E	-892 / 0	-91.8	-91.8 0.28 (1)	8.18	N-L	-116 / 0	0.02 (1)
E-F	-1616 / 0	-91.8	-91.8 0.15 (1)	5.07	S-L	0.1472	0.33 (1)
F-G	0.28	-91.8	-91.8 0.12 (1)	10.00	J-H	-116 / 0	0.02 (1)
N-B	-795 / 0	0.0	0.0 0.08 (1)	7.81	J-F	0.1472	0.33 (1)
H-F	-795 / 0	0.0	0.0 0.08 (1)	7.81			
N-M	0.104	-18.5	-18.5 0.03 (4)	10.00			
M-L	0.21	0.0	0.0 0.14 (1)	10.00			
L-C	0.102	0.0	0.0 0.16 (1)	10.00			
L-K	0.1585	-18.5	-18.5 0.32 (1)	10.00			
K-J	0.1585	-18.5	-18.5 0.32 (1)	10.00			
I-J	0.21	0.0	0.0 0.14 (1)	10.00			
J-E	0.102	0.0	0.0 0.16 (1)	10.00			
I-H	0.104	-18.5	-18.5 0.03 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 8.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 38.0	PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.45")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.04")
ALLOWABLE DEFL.(TL) = $L/360$ (0.45")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.08")

CSI: TG=0.28/1.00 (D-E:1), BC=0.32/1.00 (J-K:1),
WB=0.33/1.00 (F-J:1), SG=0.17/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.88 (C) (INPUT = 0.90)
JSI METAL = 0.43 (B) (INPUT = 1.00)




Structural component only
DWG# T-2008077

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	V30	1	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Thu Apr 30 10:05:39 2020 Page 1
ID:DMCubINVR6TslFoe31v6l_zns1l-3ggRys0LE8oPFQkHdmcaJ3lwzQoqoZKTM9wRWGzLa8A

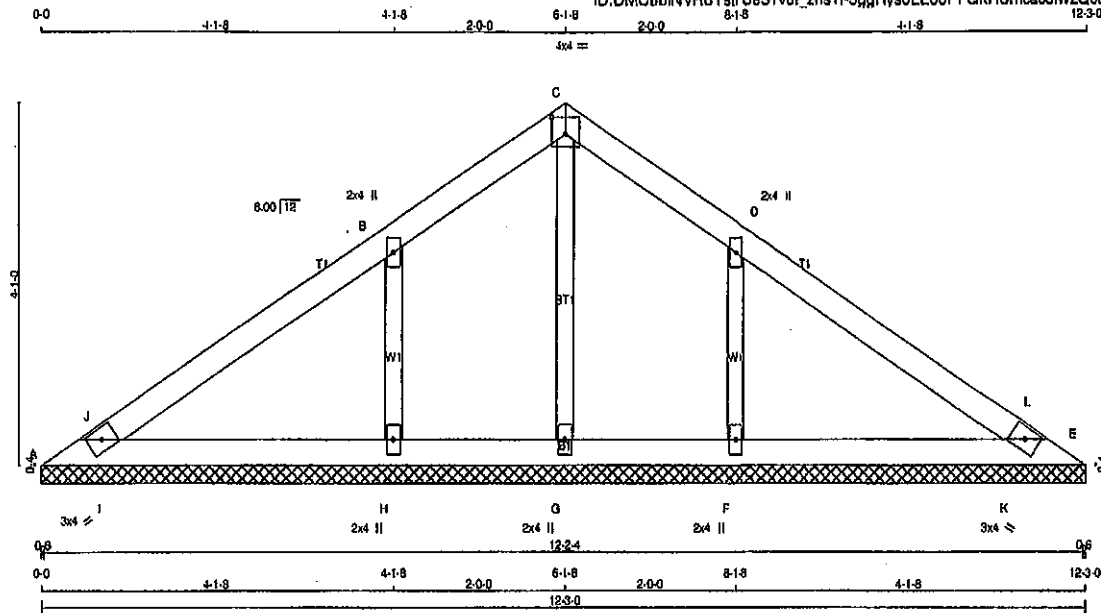

TOTAL WEIGHT = 38 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2			SPF
C - E	2x4	DRY	No.2			SPF
A - E	2x4	DRY	No.2			SPF
ALL WEBS	2x3	DRY	No.2			SPF
DRY: SEASONED LUMBER.						

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0			
B	TBM1-w	MT20	2.0	4.0			
C	TTW-p	MT20	4.0	4.0	2.25	2.00	
D	TBM1-w	MT20	2.0	4.0			
E	TBM1-h	MT20	3.0	4.0			
F, G, H	BMW1-w	MT20	2.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
A	102	0	102	0	12-3-0	12-2-4	12-3-0	12-2-4
E	102	0	102	0	12-3-0	12-2-4	12-3-0	12-2-4
G	252	0	252	0	12-3-0	12-2-4	12-3-0	12-2-4
H	444	0	444	0	12-3-0	12-2-4	12-3-0	12-2-4
F	444	0	444	0	12-3-0	12-2-4	12-3-0	12-2-4

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	72	48/0	0/0	0/0	0/0	24/0	0/0
E	72	48/0	0/0	0/0	0/0	24/0	0/0
G	179	115/0	0/0	0/0	0/0	64/0	0/0
H	314	208/0	0/0	0/0	0/0	108/0	0/0
F	314	208/0	0/0	0/0	0/0	108/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, G, H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 8.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS			WEBS		
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO		
A-J	0/150	-91.8	0.04 (4)	10.00	G-C	-291/0
J-B	0/183	-91.8	0.17 (1)	10.00	H-B	-318/0
B-C	0/151	-91.8	0.18 (1)	10.00	F-D	-318/0
C-D	0/151	-91.8	0.18 (1)	10.00	I-J	-119/3
D-L	0/183	-91.8	0.17 (1)	10.00	K-L	-119/3
L-E	0/150	-91.8	0.04 (4)	10.00		
A-I	-158/0	-18.5	0.10 (1)	8.25		
I-H	-137/0	-18.5	0.10 (1)	6.25		
H-G	-148/0	-18.5	0.08 (1)	6.25		
G-F	-148/0	-18.5	0.08 (1)	6.25		
F-K	-137/0	-18.5	0.10 (1)	8.25		
K-E	-158/0	-18.5	0.10 (1)	8.25		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.17/1.00 (B-J:1), BC=0.10/1.00 (H-I:1), WB=0.07/1.00 (G-G:1), SS=0.12/1.00 (B-J:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)

MAX MIN MAX MIN MAX MIN


MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.24 (C) (INPUT = 0.90)


JSI METAL= 0.16 (D) (INPUT = 1.00)

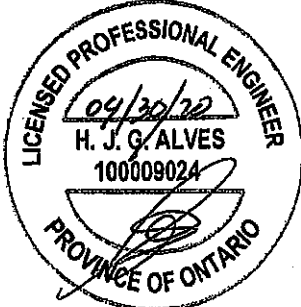

Structural component only
DWG# T-2008048

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408316	V31	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:05:40 2020 Page 1
ID:DMCubINVR6TstF0e3 1v61, zns11-XsEpAC1z7RwGsaJUB77prHr5Lp7QX?Adapl_2jzLa99

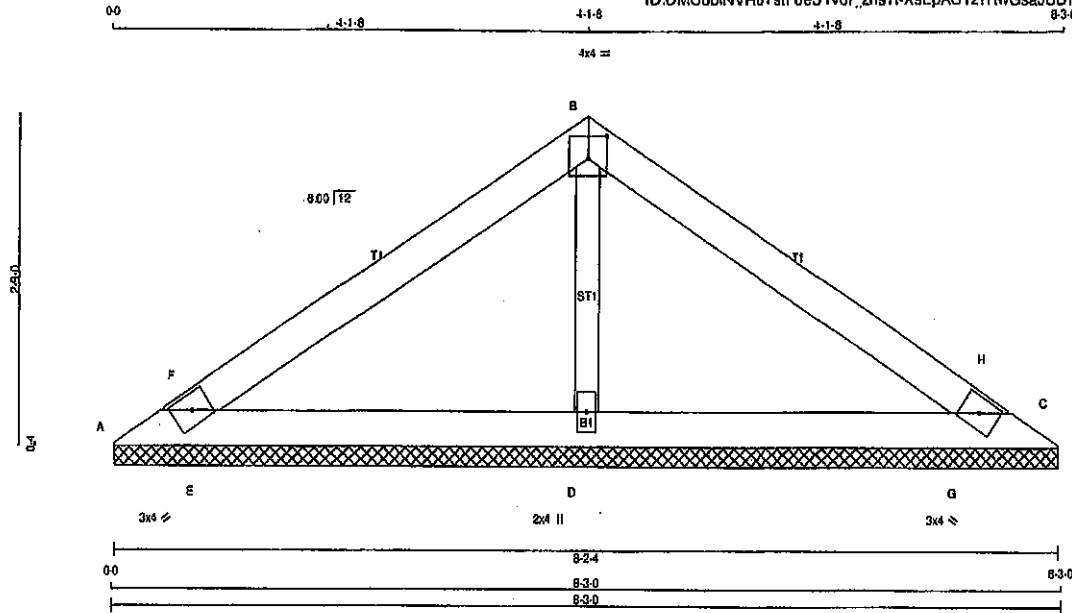

Scale = 1:17.7

TOTAL WEIGHT = 21 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
A - C	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TBM1-h	MT20	3.0	4.0	
B	TTW-p	MT20	4.0	4.0	2.25 2.00
C	TBM1-h	MT20	3.0	4.0	
D	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
A	61	0	61	0	0	8-2-4	8-2-4
C	61	0	61	0	0	8-2-4	8-2-4
D	780	0	780	0	0	8-2-4	8-2-4

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	43	287.0	0.0	0.0	0.0	15.0	0.0
C	43	287.0	0.0	0.0	0.0	15.0	0.0
D	552	3627.0	0.0	0.0	0.0	190.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX	MAX.	MEMB.	FORCE (LBS)	MAX	MAX
FR-TO		FROM	TO	LENGTH	FR-TO				
A-F	0 / 280	-91.8	-91.8	0.09 (1)	10.00	D-B	-598.0	0.10 (1)	
F-B	0 / 279	-91.8	-91.8	0.19 (1)	10.00	E-F	-195.0	0.00 (1)	
B-H	0 / 278	-91.8	-91.8	0.19 (1)	10.00	G-H	-195.0	0.00 (1)	
H-C	0 / 280	-91.8	-91.8	0.09 (1)	10.00				
A-E	-284.0	-18.5	-18.5	0.14 (1)	6.25				
E-D	-237.0	-18.5	-18.5	0.14 (1)	6.25				
D-G	-237.0	-18.5	-18.5	0.14 (1)	6.25				
G-C	-284.0	-18.5	-18.5	0.14 (1)	6.25				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. CD

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.19/1.00 (B-F:1), BC=0.14/1.00 (D-E:1), WB=0.10/1.00 (B-D:1), SSI=0.10/1.00 (B-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1897
	788	1897	1850

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.50 (B) (INPUT = 0.90)
JSI METAL= 0.17 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008049

JOB NAME 408315	TRUSS NAME PB1	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 09:31:23 2020 Page 1			
		ID:DMCubINVR8TstF0e31v61_znsf1-G8RB8RrhQCm8atZ8BzkR_V8akd5i4i6raHdLRzLatf			

0-0 2-0-0 2-0-0 3-4-0 5-4-0 2-0-0 7-4-0
Scale = 1:13.4

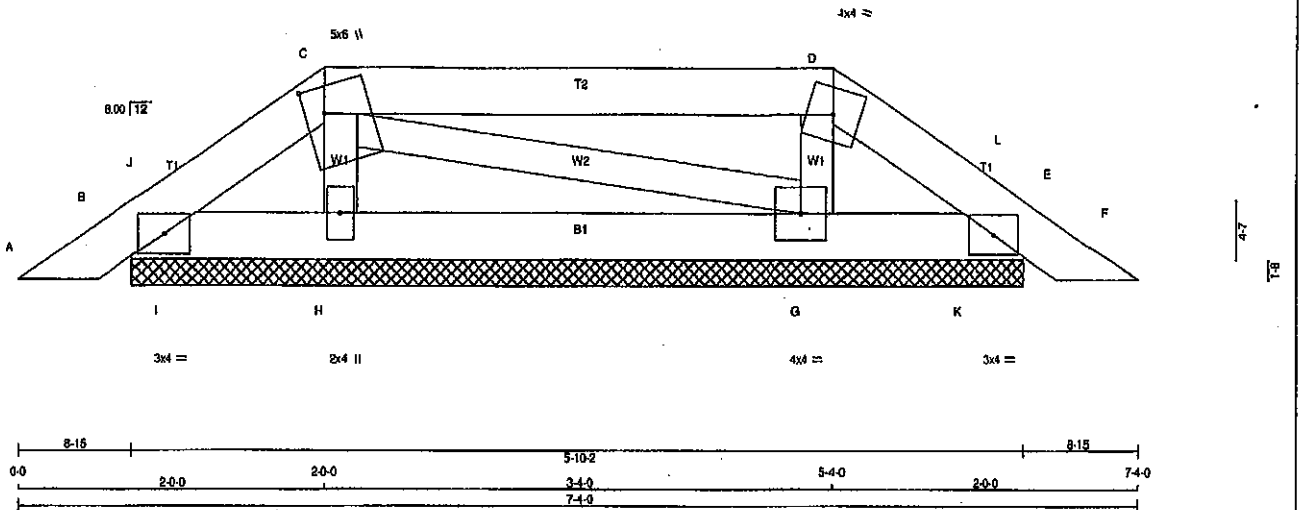

LUMBER				DESCR.	
N. L. G. A. RULES	SIZE	LUMBER		SPF	
CHORDS				SPF	
A - C	2x4	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
B - E	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (Labels in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	
C	TTWW-m	MT20	5.0	8.0	2.00 1.50
D	TTW-m	MT20	4.0	4.0	
E	TMB1-I	MT20	3.0	4.0	
G	BMWW1-I	MT20	4.0	4.0	
H	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
B	148	0	148	0	0	5-10-2	5-10-2	5-10-2	5-10-2
E	144	0	144	0	0	5-10-2	5-10-2	5-10-2	5-10-2
H	233	0	233	0	0	5-10-2	5-10-2	5-10-2	5-10-2
G	241	0	241	0	0	5-10-2	5-10-2	5-10-2	5-10-2

UNFACTORED REACTIONS

1ST LOSE		MAX/MIN COMPONENT REACTIONS		PERM/LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM/LIVE	WIND	DEAD	SOIL	PERM/LIVE	WIND	DEAD	SOIL
B	102	81/0	0/0	0/0	0/0	21/0	0/0	0/0	0/0	0/0	0/0
E	98	78/0	0/0	0/0	0/0	21/0	0/0	0/0	0/0	0/0	0/0
H	168	101/0	0/0	0/0	0/0	85/0	0/0	0/0	0/0	0/0	0/0
G	172	106/0	0/0	0/0	0/0	86/0	0/0	0/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		W E B S		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	MEMB.	FORCE (LBS)	MAX	CSI (L.C)
FR-TO		FROM	TO	FR-TO			
A-B	0/15	-91.8	-91.8 0.03 (1)	10.00	H-C	-189/0	0.02 (1)
B-J	-45/0	-91.8	-91.8 0.00 (4)	8.25	C-G	-7/0	0.00 (1)
J-C	-48/0	-91.8	-91.8 0.01 (1)	8.25	G-D	-175/0	0.02 (1)
C-D	-11/0	-91.8	-91.8 0.17 (1)	8.25	I-J	-58/0	0.00 (1)
D-L	-38/0	-91.8	-91.8 0.01 (1)	8.25	K-L	-59/0	0.00 (1)
L-E	-37/0	-91.8	-91.8 0.00 (4)	8.25			
E-F	0/15	-91.8	-91.8 0.03 (1)	10.00			
B-I	0/37	-18.5	-18.5 0.02 (1)	10.00			
I-H	0/37	-18.5	-18.5 0.03 (4)	10.00			
H-G	0/18	-18.5	-18.5 0.03 (4)	10.00			
G-K	0/31	-18.5	-18.5 0.03 (4)	10.00			
K-E	0/31	-18.5	-18.5 0.02 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GIC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.17/1.00 (C-D:1), BC=0.03/1.00 (H-I:4), WB=0.02/1.00 (D-G:1), SB=0.12/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(P8) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1867 788 1987 1856


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.12 (D) (INPUT = 0.90)
JSI METAL= 0.04 (H) (INPUT = 1.00)



Structural component only
DWG# T-2007999

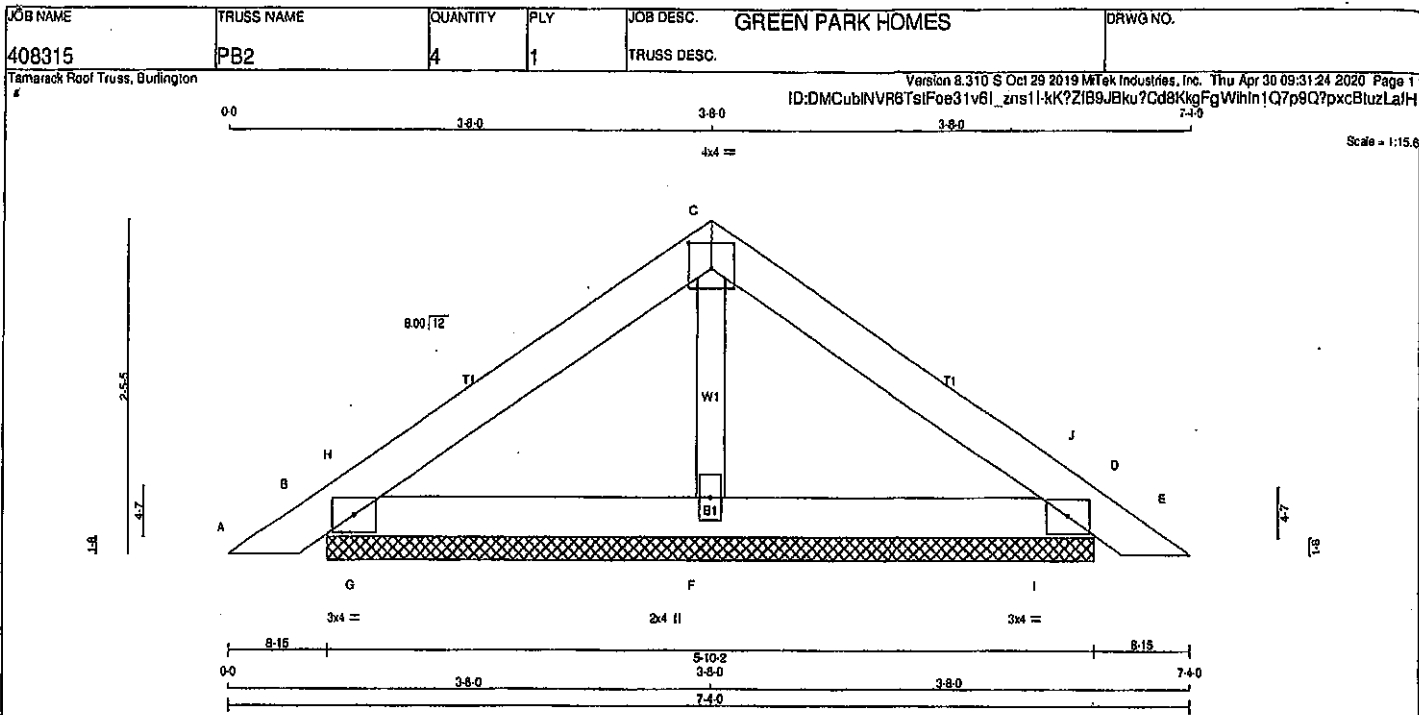

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	No.2	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
B - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B-TMB1-I	MT20	3.0	4.0		
C-TTW-p	MT20	4.0	4.0	2.25	2.00
D-TMB1-I	MT20	3.0	4.0		
F-BMW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
B	252	0	252	0	5-10-2	5-10-2
D	252	0	252	0	5-10-2	5-10-2
F	252	0	252	0	5-10-2	5-10-2

UNFACTORED REACTIONS

JT	COMBINED	MAX/MIN. COMPONENT REACTIONS				
		SNOW	LIVE	PERM. LIVE	WIND	DEAD
B	176	127 / 0	0 / 0	0 / 0	0 / 0	49 / 0
D	176	127 / 0	0 / 0	0 / 0	0 / 0	49 / 0
F	187	113 / 0	0 / 0	0 / 0	0 / 0	74 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO	UNBRAC LENGTH	FR-TO			
A-B	0 / 15	-91.8	-91.8 0.03 (1)	10.00	P-C	-126 / 0	0.02 (1)
B-H	-37 / 0	-91.8	-91.8 0.04 (1)	8.25	G-H	-219 / 0	0.00 (1)
H-C	-90 / 0	-91.8	-91.8 0.08 (1)	8.25	I-J	-219 / 0	0.00 (1)
C-J	-90 / 0	-91.8	-91.8 0.09 (1)	8.25			
J-D	-37 / 0	-91.8	-91.8 0.04 (1)	8.25			
D-E	0 / 15	-91.8	-91.8 0.03 (1)	10.00			
B-G	0 / 71	-18.5	-18.5 0.10 (1)	10.00			
G-F	0 / 71	-18.5	-18.5 0.10 (1)	10.00			
F-I	0 / 71	-18.5	-18.5 0.10 (1)	10.00			
I-D	0 / 71	-18.5	-18.5 0.10 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSF: TC=0.08/1.00 (C-H:1), SC=0.10/1.00 (B-G:1),
WB=0.02/1.00 (C-F:1), SS=0.16/1.00 (B-G:1)

OOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.22 (D) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)




Structural component only
DWG# T-2008000

JOB NAME 408315	TRUSS NAME PB3	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 09:31:28 2020 Page 1

ID:DMCubINVR6TsiFoe31v6l_zns1l-gj7J4sAZjL8lRwHjs5H8b7m8Dr7mH32IGF5HymzLaIF

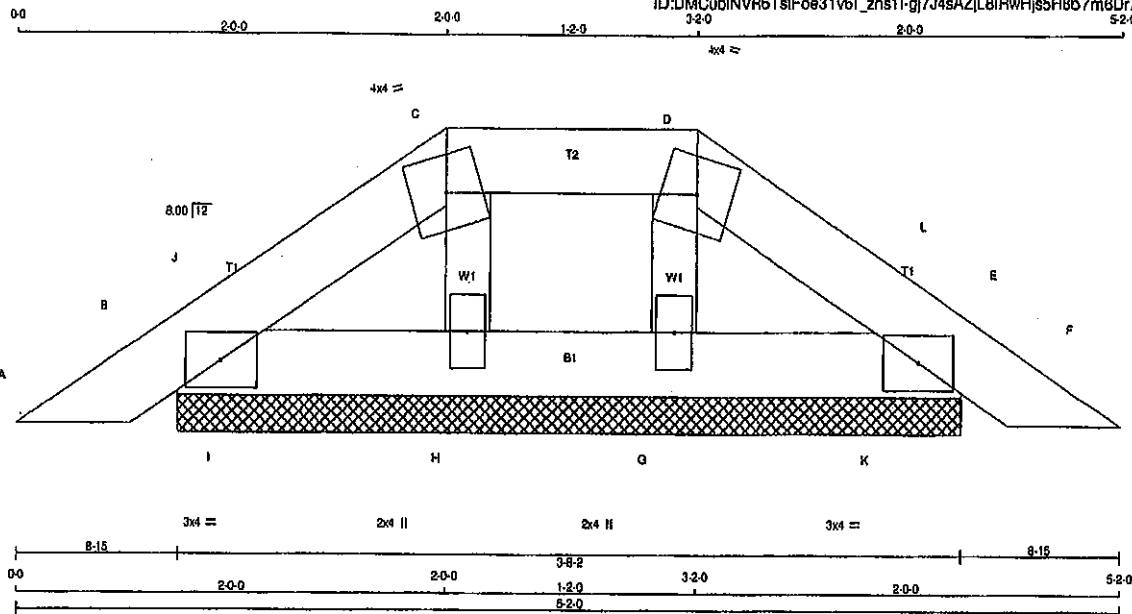

Scale = 1/8" = 1'-0"

TOTAL WEIGHT = 12 lb [M]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF
C - D	2x4 DRY	No.2	SPF
D - F	2x4 DRY	No.2	SPF
B - E	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (tablets in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMB1-I	MT20	3.0	4.0
C	TTW-m	MT20	4.0	4.0
D	TTW-m	MT20	4.0	4.0
E	TMB1-I	MT20	3.0	4.0
G	BMW1-w	MT20	2.0	4.0
H	BMW1-w	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORIZ	DOWN	HORIZ	UP/LIFT	IN-SX	IN-SX	BRG
B	144	0	144	0	0	3-8.2	3-8.2	3-8.2	
E	144	0	144	0	0	3-8.2	3-8.2	3-8.2	
H	119	0	119	0	0	3-8.2	3-8.2	3-8.2	
G	119	0	119	0	0	3-8.2	3-8.2	3-8.2	

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN	COMPONENT REACTIONS	SNOW	LIVE	PERM/LIVE	WIND	DEAD	SOIL
B	101	74/0	0/0	0/0	0/0	0/0	0/0	27/0	0/0
E	101	74/0	0/0	0/0	0/0	0/0	0/0	27/0	0/0
H	85	54/0	0/0	0/0	0/0	0/0	0/0	31/0	0/0
G	85	54/0	0/0	0/0	0/0	0/0	0/0	31/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PL)	MAX. CSI (LC)	MEMB.	MAX. FORCE (LBS)	MAX. CSI (LC)	UNBRACED LENGTH FR-TO
A-B	0/15	-91.8	-91.8 0.03 (1)	H-C	-84/0	0.01 (1)	10.00
B-J	-34/0	-91.8	-91.8 0.00 (4)	G-D	-84/0	0.01 (1)	6.25
J-C	-27/0	-91.8	-91.8 0.02 (1)	I-J	-48/0	0.00 (1)	6.25
C-D	-14/0	-91.8	-91.8 0.02 (1)	K-L	-48/0	0.00 (1)	6.25
D-L	-27/0	-91.8	-91.8 0.02 (1)				
L-E	-34/0	-91.8	-91.8 0.00 (4)				
E-F	0/15	-91.8	-91.8 0.03 (1)				
B-I	0/23	-18.5	-18.5 0.02 (1)				10.00
I-H	0/23	-18.5	-18.5 0.02 (1)				10.00
H-G	0/14	-18.5	-18.5 0.01 (1)				10.00
G-K	0/23	-18.5	-18.5 0.02 (1)				10.00
K-E	0/23	-18.5	-18.5 0.02 (1)				10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.03/1.00 (A-B:1), SC=0.02/1.00 (E-K:1), WB=0.01/1.00 (D-G:1), SSI=0.04/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (PSI) SHEAR SECTION (PLI) (PLJ)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.11 (E) (INPUT = 0.90)
JSI METAL = 0.02 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008001

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	PB4	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 28 2019 MTEK Industries, Inc. Thu Apr 30 09:31:27 2020 Page 1
ID:DMCubINVR6TslFoe31v6I_zns11-8vhiHCBBUIGZ34sQooN8LJHvETH0WHRVrrUCzLaE

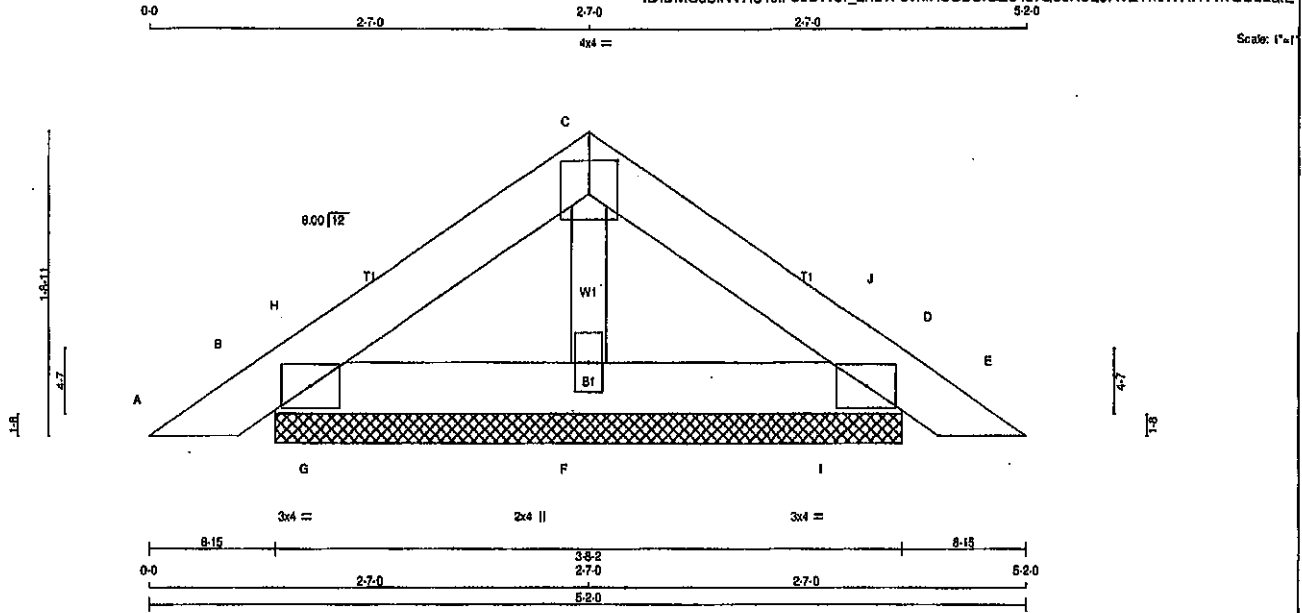

TOTAL WEIGHT = 2 X 12 = 24 lb

LUMBER			
N.L.G.A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
B - D	2x4	DRY No.2	SPF
ALL WEBS 2x3 DRY No.2 SPF			
DRY; SEASONED LUMBER.			

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMB1-I	MT20	3.0	4.0		
C TTW-p	MT20	4.0	4.0	2.25	2.00
D TMB1-I	MT20	3.0	4.0		
F BMW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX	BRG
B	175	0	175	0	0	3-8-2	3-8-2	3-8-2	3-8-2
D	175	0	175	0	0	3-8-2	3-8-2	3-8-2	3-8-2
F	178	0	178	0	0	3-8-2	3-8-2	3-8-2	3-8-2

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	122	89/0	0/0	0/0	0/0	0/0	33/0	0/0
D	122	89/0	0/0	0/0	0/0	0/0	33/0	0/0
F	127	78/0	0/0	0/0	0/0	0/0	49/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LOI MAX (PLF)	MAX. UNBRACED LENGTH	MEMB.	FORCE (LBS)	MAX. UNBRACED LENGTH
FR-TO					FR-TO		
A-B	0/15	-91.8	-91.8 0.03 (1)	10.00	F-C	-88/0	0.01 (1)
B-H	-35/0	-91.8	-91.8 0.01 (1)	6.25	G-H	-99/0	0.00 (1)
H-C	-45/0	-91.8	-91.8 0.03 (1)	6.25	I-J	-99/0	0.00 (1)
C-J	-45/0	-91.8	-91.8 0.03 (1)	6.25			
J-D	-35/0	-91.8	-91.8 0.01 (1)	6.25			
D-E	0/15	-91.8	-91.8 0.03 (1)	10.00			
B-G	0/38	-18.5	-18.5 0.04 (1)	10.00			
G-F	0/38	-18.5	-18.5 0.04 (1)	10.00			
F-I	0/38	-18.5	-18.5 0.04 (1)	10.00			
I-D	0/38	-18.5	-18.5 0.04 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS: TC=0.03/1.00 (C-J:1), BC=0.04/1.00 (F-I:1), WB=0.01/1.00 (C-F:1), SS=0.07/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (FS) (PLI) (PLI)
MAX MIN MAX MIN
MT20 618 354 1667 788 1997 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (D) (INPUT = 0.90)
JSI METAL= 0.03 (D) (INPUT = 1.00)




Structural component only
DWG# T-2008002

JOB NAME 408315	TRUSS NAME PB5	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:29 2020 Page 1

ID:DMCubINVR6TstFoe31v6f_zns11-5HpSiUOS?GWHIO0IXDqrDmOd628sUCkkyDKxZ5zLaIC

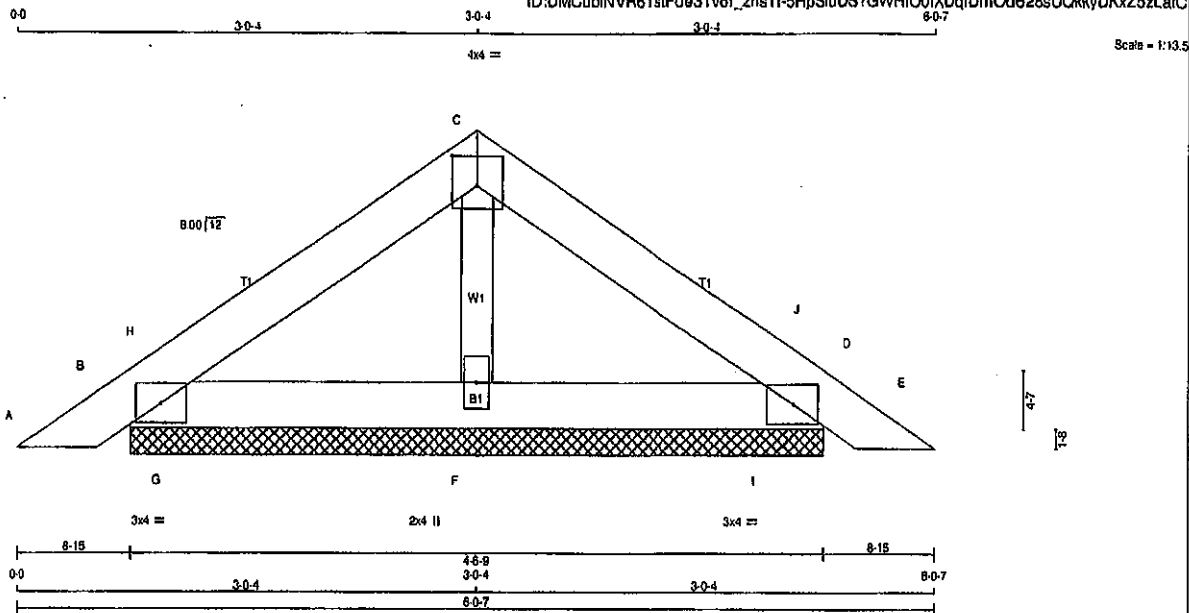

Scale = 1:13.5

TOTAL WEIGHT = 2 X 14 = 28 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
B - D	2x4	DRY	No.2
ALL WEBS 2x3 DRY No.2			
DRY; SEASONED LUMBER.			

PLATES (tablets in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TMB1-I	MT20	3.0	4.0	
F	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERY	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
B	205	0	0	205	0	0	4-8-9	4-8-9	
D	205	0	0	205	0	0	4-8-9	4-8-9	
F	213	0	0	213	0	0	4-8-9	4-8-9	

UNFACTORED REACTIONS

1ST LOOSE		MAX/MIN COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM	LIVE	WIND	DEAD	SOIL	
B	143	104/0	0/0	0/0	0/0	0/0	39/0	0/0	
D	143	104/0	0/0	0/0	0/0	0/0	39/0	0/0	
F	152	92/0	0/0	0/0	0/0	0/0	59/0	0/0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)	MAX	LC1 MAX
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0/15	-91.8	-91.8 0.03 (1)	10.00	F-C	-104/0	0.02 (1)
B-H	-38/0	-91.8	-91.8 0.02 (1)	8.25	G-H	-141/0	0.00 (1)
H-C	-62/0	-91.8	-91.8 0.05 (1)	8.25	I-J	-141/0	0.00 (1)
C-J	-62/0	-91.8	-91.8 0.05 (1)	8.25			
J-D	-38/0	-91.8	-91.8 0.02 (1)	8.25			
D-E	0/15	-91.8	-91.8 0.03 (1)	10.00			
B-G	0/49	-18.5	-18.5 0.06 (1)	10.00			
G-F	0/49	-18.5	-18.5 0.06 (1)	10.00			
F-I	0/49	-18.5	-18.5 0.06 (1)	10.00			
I-D	0/49	-18.5	-18.5 0.06 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
DI	=	6.0	PSF	
BOY CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2019, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.05/1.00 (C-H:1), BC=0.08/1.00 (B-G:1), WB=0.02/1.00 (C-F:1), SL=0.10/1.00 (B-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MT20	818	354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.17 (B) (INPUT = 0.90)
JSI METAL = 0.04 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008003


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408315	PB5Z	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Metek Industries, Inc. Thu Apr 30 09:31:30 2020 Page 1

ID:DMCubiNVR6TsFoa31v6l_zns1f-ZUMqWED4mae8wYbU5xM4mzxoGSUJZD5iB4V5x2Laif

Scale = 1:13.5

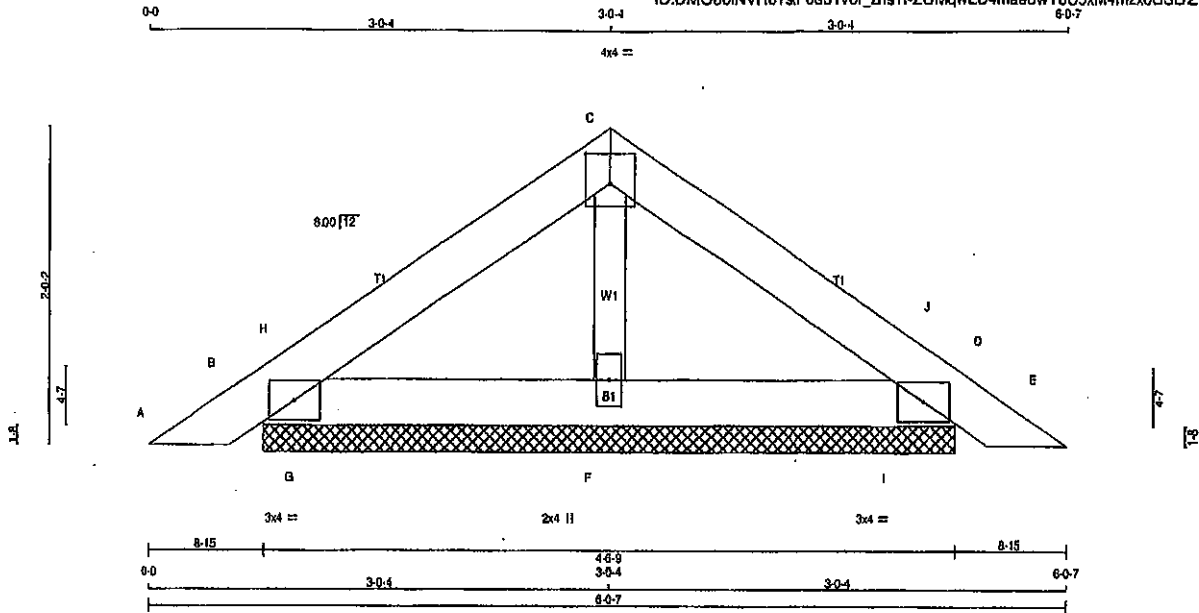

TOTAL WEIGHT = 2 X 14 = 28 k (M)

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
B - D	2x4	DRY	No.2	SPF	
ALL WEBS		2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.					

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 1 12		TOP
C - E 1 12		TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
B - D 1 12		TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1 8		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0		
C	TTW-P	MT20	4.0	4.0	2.25	2.00
D	TMB1-I	MT20	3.0	4.0		
F	BMW1-w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
B	208	0	208	0	0	4-8-9
D	208	0	208	0	0	4-8-9
F	212	0	212	0	0	4-8-9

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	144	104 / 0	0 / 0	0 / 0	0 / 0	39 / 0	0 / 0
D	144	104 / 0	0 / 0	0 / 0	0 / 0	39 / 0	0 / 0
F	151	92 / 0	0 / 0	0 / 0	0 / 0	59 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LCI	MAX. CSI (LC)	UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO				FR-TO			
A-B	0 / 15	-91.8	-91.8	0.01 (1)	10.00	F-C	-104 / 0	0.01 (1)	
B-H	-40 / 0	-91.8	-91.8	0.01 (1)	6.25	G-H	-139 / 0	0.00 (1)	
H-C	-82 / 0	-91.8	-91.8	0.03 (1)	6.25	I-J	-139 / 0	0.00 (1)	
C-J	-82 / 0	-91.8	-91.8	0.03 (1)	6.25				
J-D	-40 / 0	-91.8	-91.8	0.01 (1)	6.25				
D-E	0 / 15	-91.8	-91.8	0.01 (1)	10.00				
B-G	0 / 49	-18.5	-18.5	0.03 (1)	10.00				
G-F	0 / 49	-18.5	-18.5	0.03 (1)	10.00				
F-I	0 / 49	-18.5	-18.5	0.03 (1)	10.00				
I-O	0 / 49	-18.5	-18.5	0.03 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.03/1.00 (C-H:1), BC=0.03/1.00 (B-G:1), WB=0.01/1.00 (C-F:1), SSI=0.05/1.00 (B-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.09 (B) (INPUT = 0.90)
JSI METAL = 0.02 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008004

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	J1	6	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Thu Apr 30 09:31:20 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-sZm2pp6o7VOZ?qZVqAkMsWznQ2itLkPuJezk6zLafL

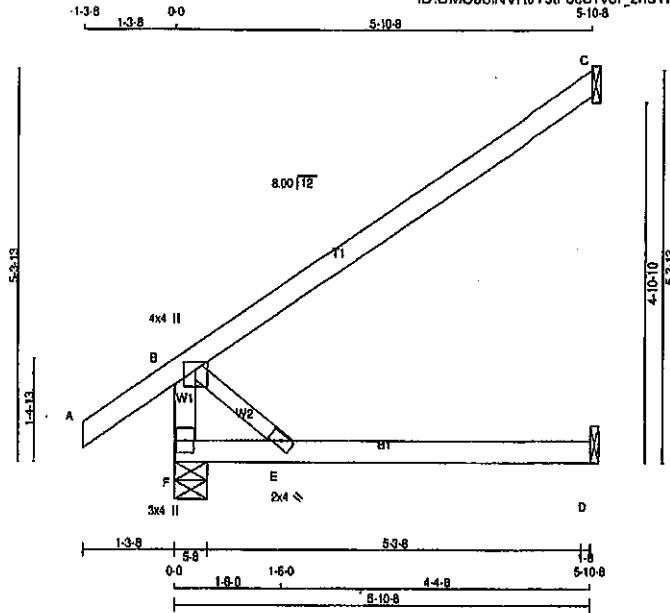

TOTAL WEIGHT = 6 X 19 = 115 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF		
A - C	2x4	DRY	No.2	SPF		
F - D	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
DRY; SEASONED LUMBER.						

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
E	BMW+w	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
F	450	0	450	0
C	270	0	270	0
D	54	0	61	0

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	316	221/0	0/0	0/0	0/0	95/0	0/0
C	188	150/0	0/0	0/0	0/0	35/0	0/0
D	43	0/0	0/0	0/0	0/0	43/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LOAD LC1	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LOAD LC1
FR-TO	FROM	TO	FROM	TO	FROM	TO	FROM
F-B	-385/0	0.0	0.0	0.04 (1)	7.81	B-E	0/0
A-B	0/35	-91.8	-91.8	0.12 (1)	10.00		
B-C	0/0	-91.8	-91.8	0.54 (1)	10.00		
F-E	0/0	-18.5	-18.5	0.14 (4)	10.00		
E-D	0/0	-18.5	-18.5	0.19 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.54/1.00 (B-C:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354
	1897	788
	1997	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.28 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007997

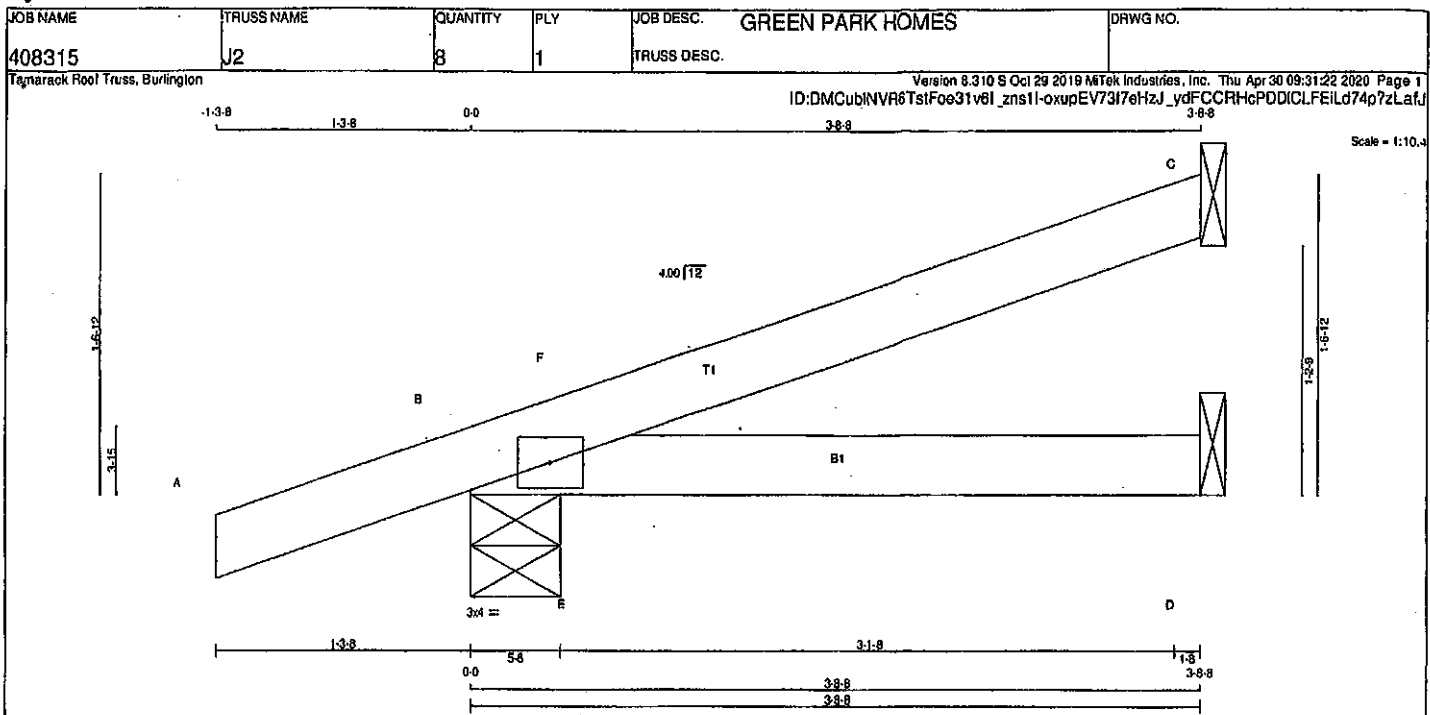

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No. 2	SPF
B - D	2x4	DRY	No. 2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TM81-I	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
C	148	0	148	0	1-8	1-8
B	327	0	327	0	5-8	5-8
D	58	0	58	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
JT	1ST CASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
C	101	78/0	0/0	0/0	0/0	23/0	0/0
B	229	183/0	0/0	0/0	0/0	66/0	0/0
D	43	17/0	0/0	0/0	0/0	27/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 (LC)	MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM	TO			FR-TO			
A-B	0/18	-91.8	-91.8	0.13 (5)	10.00	E-F	-146/6	0.00 (1)	
B-F	-11/0	-91.8	-91.8	0.04 (4)	8.25				
F-C	0/2	-91.8	-91.8	0.16 (1)	10.00				
B-E	0/0	-18.5	-18.5	0.12 (1)	10.00				
E-D	0/0	-18.5	-18.5	0.12 (1)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.02")

CS: TC=0.18/1.00 (C-F:1), BC=0.12/1.00 (B-E:1), WB=0.00/1.00 (E-F:1), SI=0.12/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.21 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007998

JOB NAME 408316	TRUSS NAME J30	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:05:21 2020 Page 1 ID:DMCubINVR6TstFoe31v8l_zns1l-bDbdAio2TcXz4fMqZ_MaGYpB9fTbR7qDMZUljzLa9S	

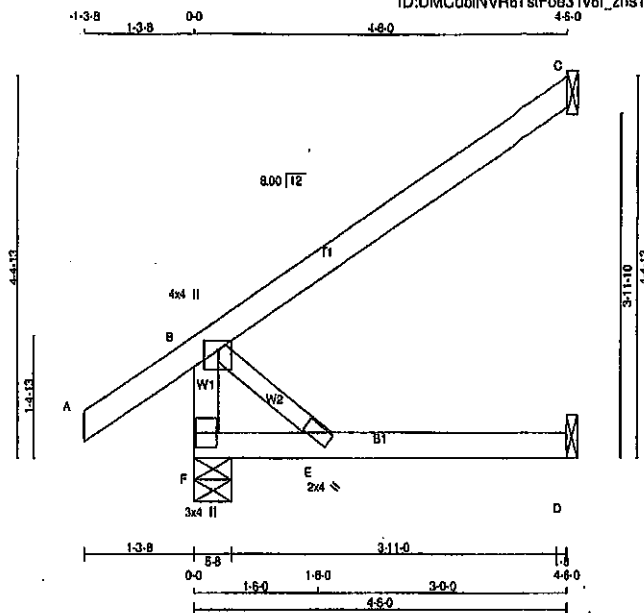

Scale = 1/24.0

TOTAL WEIGHT = 2 X 18 = 31 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
F	374	0	374	0	0	5-8	5-8		
C	206	0	206	0	0	1-8	1-8		
D	42	0	47	0	0	1-8	1-8		

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOSE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	262	185/0	0/0	0/0	0/0	77/0	0/0
C	142	115/0	0/0	0/0	0/0	27/0	0/0
D	33	0/0	0/0	0/0	0/0	33/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEB		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PL)	LC1 MAX (LC)	MEMB.	MAX. FORCE (LBS)	MAX. (LBS)	LC1 (LC)
FR-TO		FROM	TO	FR-TO			
F-B	-332/0	0.0	0.0	0.03 (1)	7.81	B-E	0/0
A-B	0/35	-91.8	-91.8	0.12 (1)	10.00		
B-C	0/0	-91.8	-91.8	0.32 (1)	10.00		
F-E	0/0	-18.5	-18.5	0.10 (4)	10.00		
E-D	0/0	-18.5	-18.5	0.11 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.8 PSF
	DL	= 8.0 PSF
BOT CH.	LL	= 0.0 PSF
	DL	= 7.4 PSF
TOTAL LOAD		= 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPC 2011, TPC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.02")

CSI: TC=0.32/1.00 (B-C:1), BC=0.11/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PL)
MT20	818	354	1687
			788
			1987
			1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.23 (B) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)




Structural component only
DWG# T-2008026

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	ORWG NO.
408315	C2	1	1	TRUSS DESC.		

Tamareck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Thu Apr 30 09:31:10 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns11-8e9GjO_XUR7_WT3awk?Oyl6MmOdPXqGxbmDROizLaFv

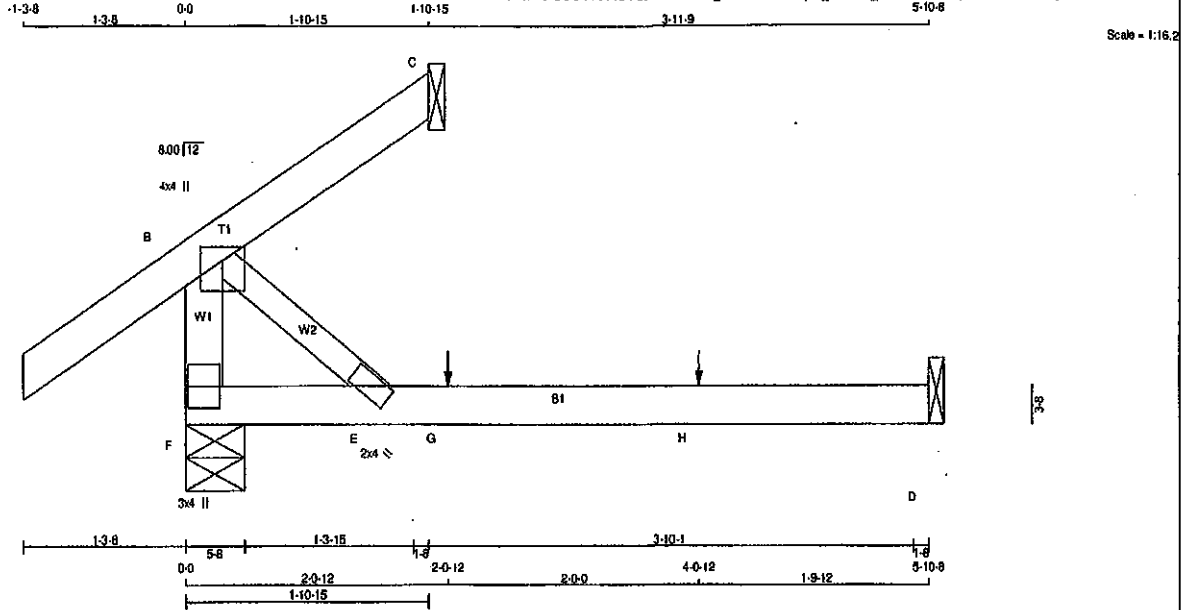

TOTAL WEIGHT = 14 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY; SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
JT.	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
F	313	0	313	0	0	5-8	5-8
C	42	0	42	0	0	1-8	1-8
D	54	0	61	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
JT	1ST CASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
F	222	144/0	0/0	0/0	0/0	77/0	0/0
C	29	24/0	0/0	0/0	0/0	6/0	0/0
D	43	0/0	0/0	0/0	0/0	43/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
F-B	-259/0	0.0	0.0 0.03 (1)	7.81	B-E	0/0	0.00 (1)
A-B	0/35	-91.8	-91.8 0.13 (1)	10.00			
B-C	-25/0	-91.8	-91.8 0.12 (1)	6.25			
F-E	0/0	-18.5	-18.5 0.14 (4)	10.00			
E-G	0/0	-18.5	-18.5 0.19 (4)	10.00			
G-H	0/0	-18.5	-18.5 0.19 (4)	10.00			
H-D	0/0	-18.5	-18.5 0.19 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE
G	2-0-12	1	1	---	FRONT	VERT	TOTAL
H	4-0-12	1	1	---	FRONT	VERT	TOTAL

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/380 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.13/1.00 (A-B:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.09/1.00 (B-C:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007990

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408315	C3	1	1	GREEN PARK HOMES	
Truss Desc.				Version 8.310 S Oct 29 2019 M Tek Industries, Inc. Thu Apr 30 09:31:12 2020 Page 1	

Truss Desc. 408315

ID:DMCubINVR6TstFos31v6f_zns11-50H184?n02NimnD1191s1ABqUCLV7kE23iYsazLaT

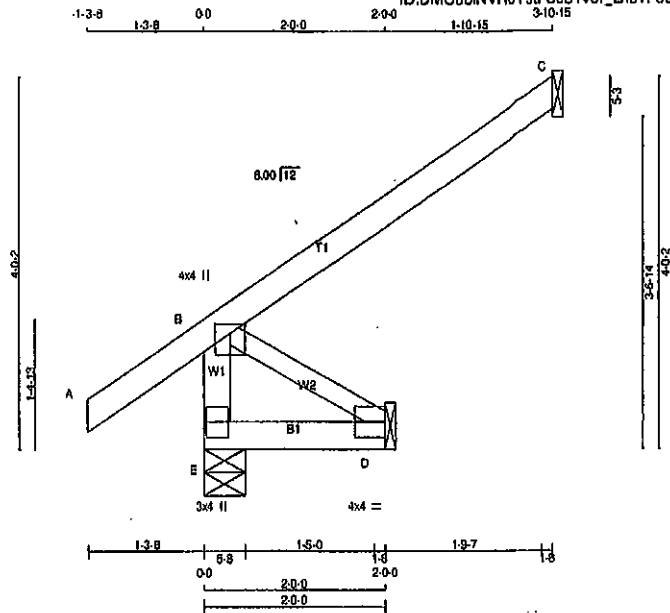

Scale = 1:23.0

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
D	BMV1-l	MT20	4.0	4.0	2.00	Edge
E	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS						
	FACTORED		MAXIMUM FACTORED		INPUT	REQRD
	GROSS REACTION		GROSS REACTION		BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
E	323	0	323	0	0	5-8
C	179	0	179	0	0	1-8
D	18	0	20	0	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED						
E	224	170 / 0	0 / 0	0 / 0	0 / 0	54 / 0	0 / 0
C	124	108 / 0	0 / 0	0 / 0	0 / 0	23 / 0	0 / 0
D	14	0 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD	PLF	CS1 (LC)	UNBRAC	LENGTH	FR-TO	FORCE (LBS)
E-B	-305 / 0	0.0	0.0	0.03 (1)	7.81	FR-TO	E-B	0 / 0
A-B	0 / 35	-91.8	-91.8	0.13 (6)	10.00		B-D	0 / 0
B-C	0 / 0	-91.8	-91.8	0.24 (1)	10.00			
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.24/1.00 (B-C:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (B-D:1), SSI=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (ORY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1687	788	1987	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.80)
JSI METAL = 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007991

Version: 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 09:31:13 2020 Page 1
ID:DMCubINVR6TslFoe31v6l_zns1l-ZCrPLQ0PnMVZNwoDbsY5aOkl1bhkkB7NHjS5_0zLaIS
1-10-15 2-0-0




JSI GRIP= 0.18 (8) (INPUT = 0.90)
JSI METAL= 0.05 (8) (INPUT = 1.00)

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN



Tamarack Roof Truss, Burlington Version 8.310 \$ Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:50:25 2020 Page 1



REARINGS	FACTORED		MAXIMUM FACTORED		INPUT	REQRD
	GROSS REACTION		GROSS REACTION		BRG	BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
JT	405	0	405	0	5-8	5-8
E	405	0	405	0	5-8	5-8
C	130	0	130	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	288	190 / 0	0 / 0	0 / 0	0 / 0	98 / 0	0 / 0
C	90	73 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	38	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E. C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LCG (IN)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LCG (IN)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO			FR-TO				
E-B	-342 / 0	0.0	0.0	0.13 (4)	7.81				
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00				
B-C	-19 / 0	-91.8	-91.8	0.22 (1)	8.25				
E-D	0 / 0	-18.5	-18.5	0.13 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	8.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD =		39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.03")

CS: TC=0.22/1.00 (B-C:1), BC=0.13/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SS=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	818	354	1687	788	1987	1058

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (E) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2008050

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408317	C52	4	1	TRUSS DESC.		

Tamarack Roof Truss, Sudlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Thu Apr 30 10:50:28 2020 Page 1

ID:DMCubINVR6TgF0e31v6I_zns11-Mo5c6_YRC1S0jWEu5HrwFvdGkzD0cGv7SM2lsSzLZVA

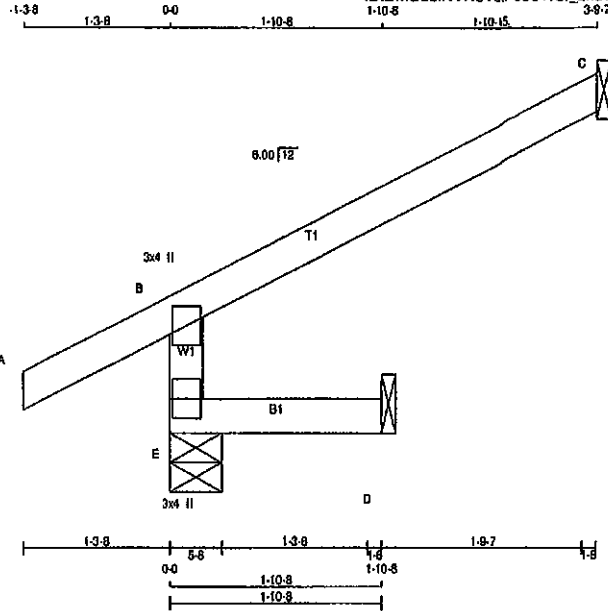

Scale = 1:18.2

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED	MAXIMUM FACTORED	INPUT	REQD			
	GROSS REACTION	GROSS REACTION	BRG	BRG			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	381	0	381	0	0	5-8	5-8
C	130	0	130	0	0	1-8	1-8
D	16	0	17	0	0	1-8	1-8

SEE MTEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
1ST CASE	MAX/MIN	COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	250	190/0	0/0	0/0	0/0	60/0	0/0
C	90	73/0	0/0	0/0	0/0	17/0	0/0
D	12	0/0	0/0	0/0	0/0	12/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (6)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
E-B	-342/0	0.0	0.0 (4)	7.81			
A-B	0/28	-91.8	-91.8 (5)	10.00			
B-C	-19/0	-91.8	-91.8 (1)	6.25			
E-D	0/0	-18.5	-18.5 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TO=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (v-a:3), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION	(PSI)	(PLI)
				MAX	MIN
MT20	818	354	1887	788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.14 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2008052

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408317	C53	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Thu Apr 30 10:50:29 2020 Page 1

ID:DMCubINVR6tstFoe31v6l_zns11-1BDMXfahkeikzqNHChOKKiesmv94AOQwgXmwMzLZV8

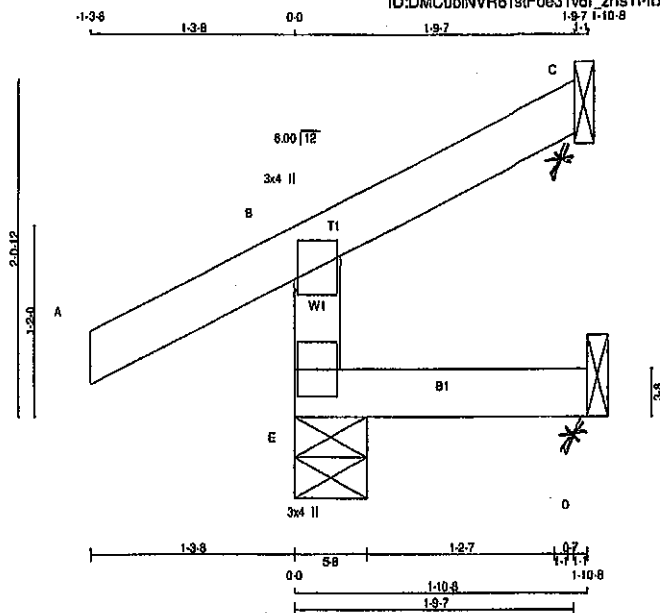

Scale = 1:13.1

TOTAL WEIGHT = 4 X 7 = 28 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No. 2	
A - C	2x4	DRY	No. 2	
E - D	2x4	DRY	No. 2	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE	PLATES			
B TMV+p	MT20	3.0	4.0	
E BMV1+p	MT20	3.0	4.0	

DESCR.
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
E	271	0	271	0	5-8	5-8	5-8	5-8
C	45	0	45	0	1-8	1-8	1-8	1-8
D	8	0	17	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT

PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	188	141 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0
C	31	24 / -18	0 / 0	0 / 0	0 / 0	7 / 0	0 / 0
D	7	0 / -8	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO. 2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO		FROM TO			FR-TO		
E-B	-244 / 0	0.0	0.0	0.04 (5)	7.81		
A-B	0 / 28	-91.8	-91.8	0.12 (1)	10.00		
B-C	-17 / 0	-91.8	-91.8	0.09 (1)	6.25		
E-D	0 / 0	-18.5	-18.5	0.04 (5)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
DL = 6.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD = 39.0	PSF	

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2016

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCG 2010, NBCG 2012, ABC 2019
- PART 9 OF NBCG 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CSK: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5), WB=0.00/1.00 (V=0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (ORY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1887
	788	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008053

LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.


Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1 1/2" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options Information on p. 126.

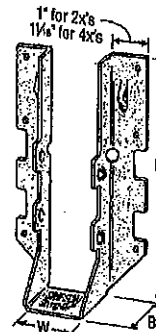


LUS28




LU26L

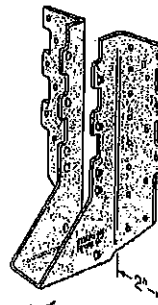

HUS210
(HUS26, HUS28,
and HHUS similar)

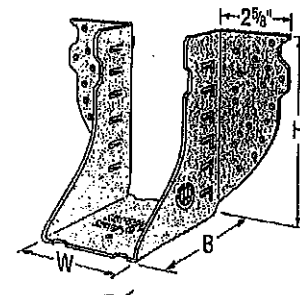

HGUS28-2



HHUS210-2



Double-Shear
Nailing
Top View





Double-Shear
Nailing
Side View;
Do not bend tab



Dome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,803,560

Typical HUS28
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

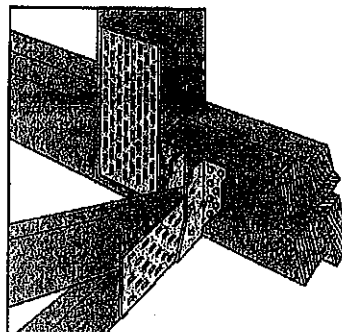

LJS26DS

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS

HHUS/HGUS

See Hanger Options information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value

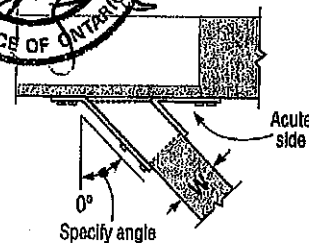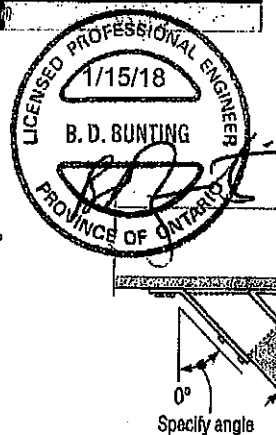

Top View HHUS Hanger
Skewed Right
(joist must be bevel cut)
All joist nails installed on the
outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ³	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb.	(K _D = 1.00) lb.	(K _D = 1.15) lb.	(K _D = 1.00) lb.
Single 2x Sizes											
LUS24	18	1 1/8	3 1/2	1 1/4	2 1/4	(4) 10d	(2) 10d	710 3.16	1625 7.23	645 2.87	1155 5.14
LU24L	22	1 1/8	3	1 1/4	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360 1.60	1020 4.54	320 1.42	725 3.22
LU26L	22	1 1/8	5	1 1/4	4 1/4	(6) 10d	(4) 10d x 1 1/2"	720 3.20	1605 7.14	645 2.87	1140 5.07
LUS26	18	1 1/8	4 1/4	1 1/4	3 3/4	(4) 10d	(4) 10d	1420 6.32	2170 9.65	1290 5.74	1630 7.25
HUS26	18	1 1/8	5 1/4	3	3 1/8	(14) 16d	(6) 16d	2705 11.30	4940 21.97	2065 9.20	3675 17.24
LJS26DS	18	1 1/8	5	3 1/2	4 1/4	(16) 16d	(6) 16d	2055 9.14	4265 18.97	1480 6.49	4115 18.31
HGUS26	12	1 1/8	5 1/4	5	4 1/4	(20) 16d	(8) 16d	2685 11.96	6625 28.51	2685 11.96	5700 25.35
LU28L	20	1 1/8	6 1/4	1 1/4	5 1/4	(8) 10d	(6) 10d x 1 1/2"	1140 5.07	2185 9.72	1020 4.54	1550 6.89
LUS28	18	1 1/8	6 1/4	1 1/4	3 3/4	(6) 10d	(4) 10d	1420 6.32	2520 11.21	1290 5.74	1780 7.96
HUS28	16	1 1/8	7 1/4	3	6 1/8	(22) 16d	(8) 16d	3605 16.04	5365 23.88	2875 11.30	4345 19.33
HGUS28	12	1 1/8	7 1/4	5	6 1/4	(36) 16d	(12) 16d	3310 14.74	7875 34.19	3310 14.74	6900 30.73
LU210L	20	1 1/8	8	1 1/4	7 1/4	(10) 10d	(6) 10d x 1 1/2"	1140 5.07	2495 11.10	1020 4.54	1770 7.87
LUS210	18	1 1/8	7 1/4	1 1/4	3 3/4	(8) 10d	(4) 10d	1420 6.32	2785 12.39	1290 5.74	2210 9.83

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-Q-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/4" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)					Fasteners		Factored Resistance			
		W	H	B	d _o ²	Header	Joist		D-Fir-L		S-P-F	
									Uplift	Normal	Uplift	Normal
									(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)
									lb.	lb.	lb.	lb.
									kN	kN	kN	kN
Double 2x Sizes												
LUS24-2	18	3 1/8	3 1/8	2	1 1/2	(4) 16d	(2) 16d		835	2020	590	1435
									3.71	8.99	2.62	6.38
SS LUS26-2	18	3 1/8	4 1/8	2	4	(4) 16d	(4) 16d		1720	2595	1545	1920
									7.65	11.54	6.87	8.64
HHUS26-2	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d		2850	7335	2065	5205
									12.68	32.63	9.20	23.15
HGUS26-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d		4385	8950	3110	6355
									19.51	39.81	13.83	28.27
SS LUS28-2	18	3 1/8	7	2	4	(8) 16d	(4) 16d		1720	3325	1545	2675
									7.65	14.79	6.87	11.45
HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d		3785	8940	2675	6345
									16.75	39.77	11.90	28.22
HGUS28-2	12	3 1/8	7 1/8	4	8 1/8	(36) 16d	(12) 16d		6070	12980	4310	9215
									27.00	57.74	19.17	40.99
SS LUS210-2	18	3 1/8	9	2	6	(8) 16d	(8) 16d		2580	4500	2320	3195
									11.48	20.02	10.32	14.21
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d		4670	9670	4235	7000
									20.77	42.97	18.84	31.14
HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d		6840	14015	4855	10270
									30.43	62.34	21.60	45.69
Triple 2x Sizes												
HGUS26-3	12	4 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d		4385	8950	3110	6355
									19.51	39.81	13.83	28.27
HGUS28-3	12	4 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d		6070	12980	4310	9215
									27.00	57.74	19.17	40.99
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d		4670	9670	4235	6865
									20.77	42.97	18.84	30.54
HGUS210-3	12	4 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d		6840	14645	4855	10400
									30.43	65.14	21.60	46.26
Quadruple 2x Sizes												
HGUS26-4	12	6 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d		4385	8950	3110	6355
									19.51	39.81	13.83	28.27
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d		6070	12980	4310	9215
									27.00	57.74	19.17	40.99
HHUS210-4	14	6 1/8	9	3	7 1/8	(30) 16d	(10) 16d		4670	10155	4235	7210
									20.77	45.17	18.84	32.07
HGUS210-4	12	6 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d		6840	14645	4855	10400
									30.43	65.14	21.60	46.26
HGUS212-4	12	6 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d		7640	14995	5425	10645
									33.98	66.70	24.13	47.35
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d		10130	16400	7195	11645
									45.06	72.95	32.00	51.80
4x Sizes												
LUS46	18	3 1/8	4 1/8	2	3 1/8	(4) 16d	(4) 16d		1720	2595	1545	1920
									7.65	11.54	6.87	8.64
HHUS46	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d		2850	7335	2065	5205
									11.30	32.63	9.20	23.15
HGUS46	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d		4385	8950	3110	6355
									19.51	39.81	13.83	28.27
LUS48	18	3 1/8	6 1/8	2	3 1/8	(6) 16d	(4) 16d		1720	3325	1545	2675
									7.65	14.79	6.87	11.45
HHUS48	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d		3785	8940	2675	6345
									16.75	39.77	11.90	28.22
HGUS48	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d		6070	12980	4310	9215
									27.00	57.74	19.17	40.99
LUS410	18	3 1/8	8 1/8	2	5 1/8	(8) 16d	(6) 16d		2580	4500	2320	3195
									11.48	20.02	10.32	14.21
HGUS410	12	3 1/8	9	4	8 1/8	(46) 16d	(16) 16d		6840	14015	4855	10270
									30.43	62.34	21.60	45.69
HGUS412	12	3 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d		7640	14995	5425	10645
									33.98	66.70	24.13	47.35
HGUS414	12	3 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d		10130	16400	7195	11645
									45.06	72.95	32.00	51.80



Plated Truss Connectors

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1¼". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1½" = 0.148" dia. x 1½" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

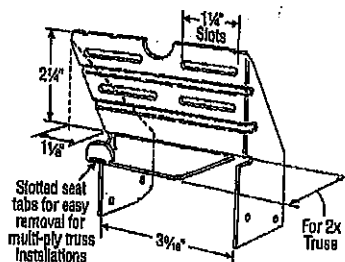


TC24
U.S. Patent 4,932,173

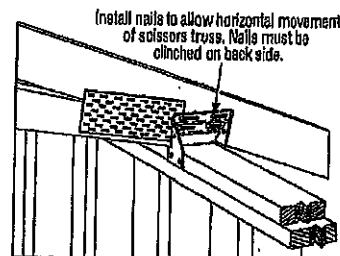


Typical TC24 Installation

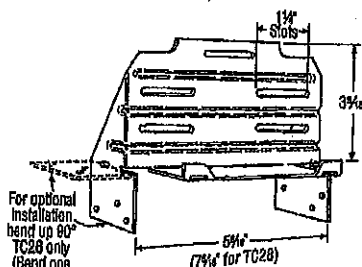

TC26
(TC28 Similar)

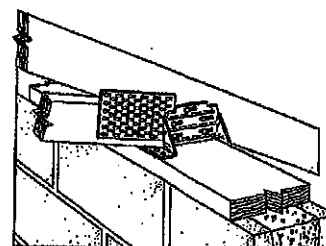

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer (8", 10", 12" Wall Installation Similar)

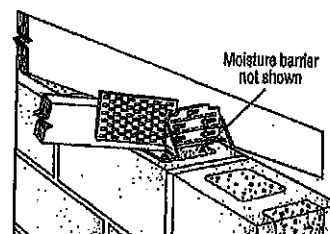

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _o =1.15)	Uplift (K _o =1.15)
TC24	(4) 10d	(4) 10d	605	430
TC26	(6) 10d	(6) 10d	1015	720
TC28	(6) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K _o =1.15)	Uplift (K _o =1.15)
TC26	(5) 10d	(6) 10d x 1½"	810	680
	(5) 10d	(6) 10d	930	680

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.
4. TC28 fastened to grouted concrete block with (6) - ¾" x 2¼" Titen screws has a factored uplift resistance of 276 lb.



LIMIT
PLATES
DESIGN

(800) 999-5099
strongtie.com

H/TSP

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_0 = 1.15$)					
					D.Fir-L			S-P-F		
		To Rafters/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(6) 8d x 1½"	(4) 8d	—	740	685	300	680	485	215
					3.29	3.05	1.33	3.02	2.16	0.96
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	805	180	180	755	160	160
					3.58	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	180	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	265	615	125	190
					3.29	0.80	1.18	2.74	0.66	0.85
H6	16	—	(3) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ³	18	(5) 10d x 1½"	(5) 10d x 1½"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A ⁴	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1735	795	410	1505	585	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1835	1275	430	1645	880	305
					8.18	5.67	1.91	7.32	3.91	1.36
H10S ^{5,6}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1465	795	315	1040	585	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	[1] (12) 8d x 1½"	(13) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
		[2] (12) 8d x 1½"	(15) 8d	—	2390	855	320	1805	610	230
					10.63	3.80	1.42	8.03	2.71	1.02
TSP	16	(9) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
					5.76	1.96	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.96	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 695 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTTECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.61 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCMR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 485 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.162" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27–28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

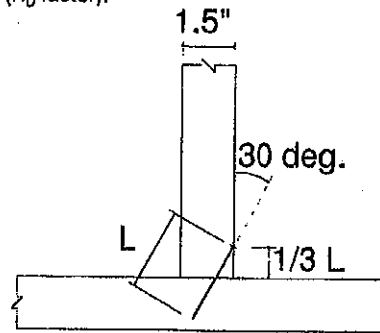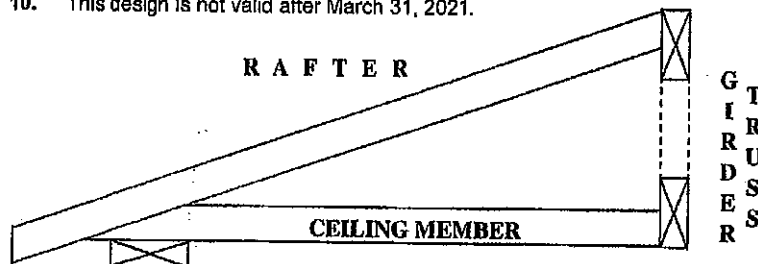


TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (In)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to wind or earthquake load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

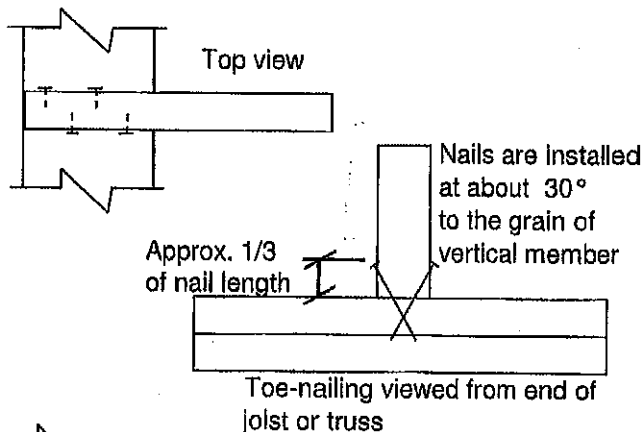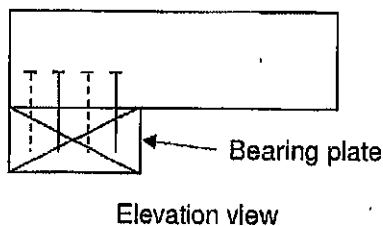

Toe-nailing on 2x4 Bearing Plate

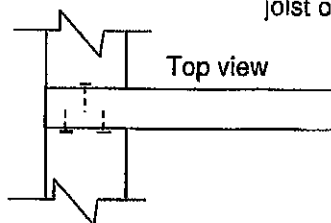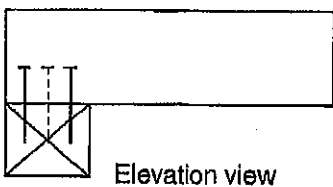

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7


December 2, 2019

PEO
Certificate No. 10889485




Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint, unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/8" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

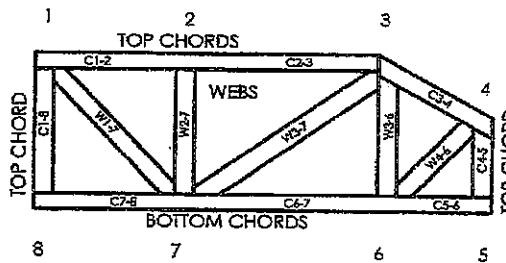

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MII-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane of joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected ovetop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

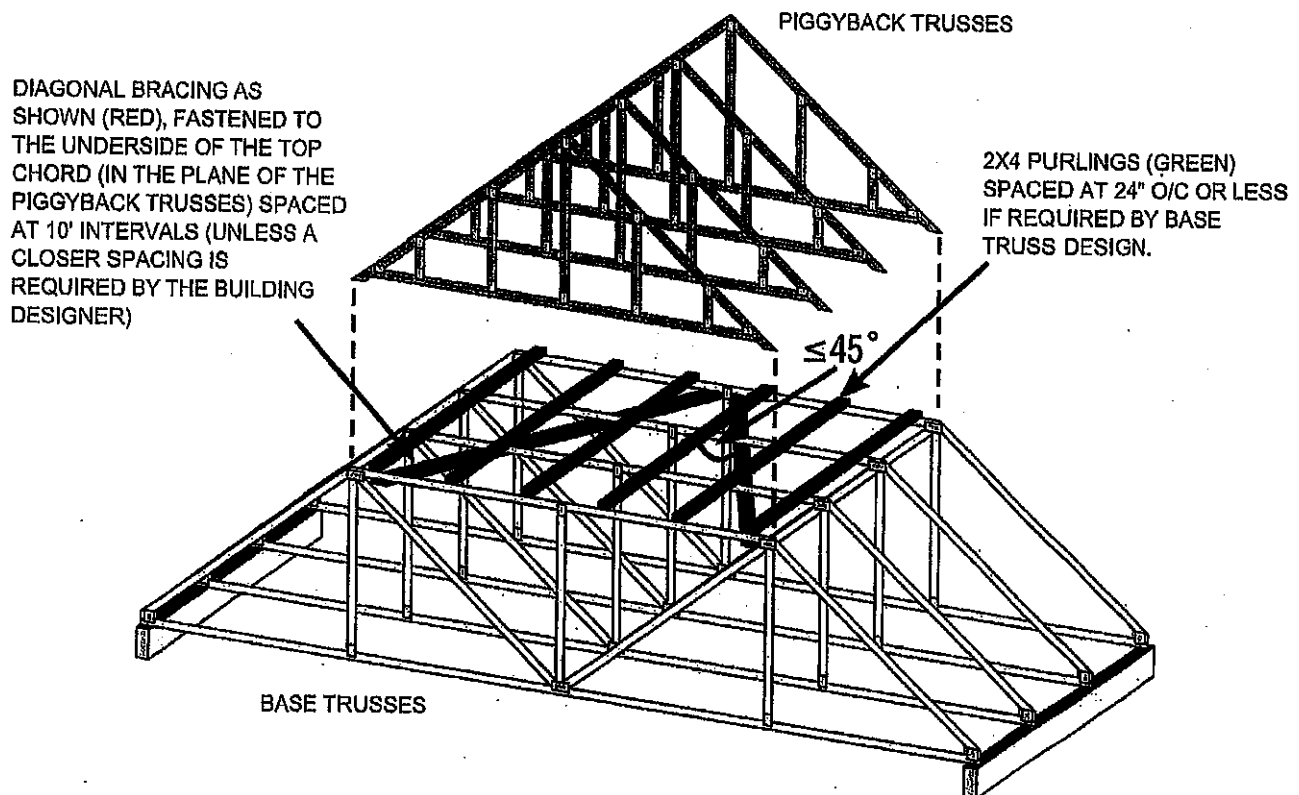

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet M117473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1800215

Feb 09, 2018