

6/12 roof pitch unless noted

CITY OF HAMILTON
Building Division

Permit No. 21-111561


THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAWS

These drawings and/or specifications have been reviewed

FOR CHIEF BUILDING OFFICIAL

MARCH 30/21
DATE

36-00-00

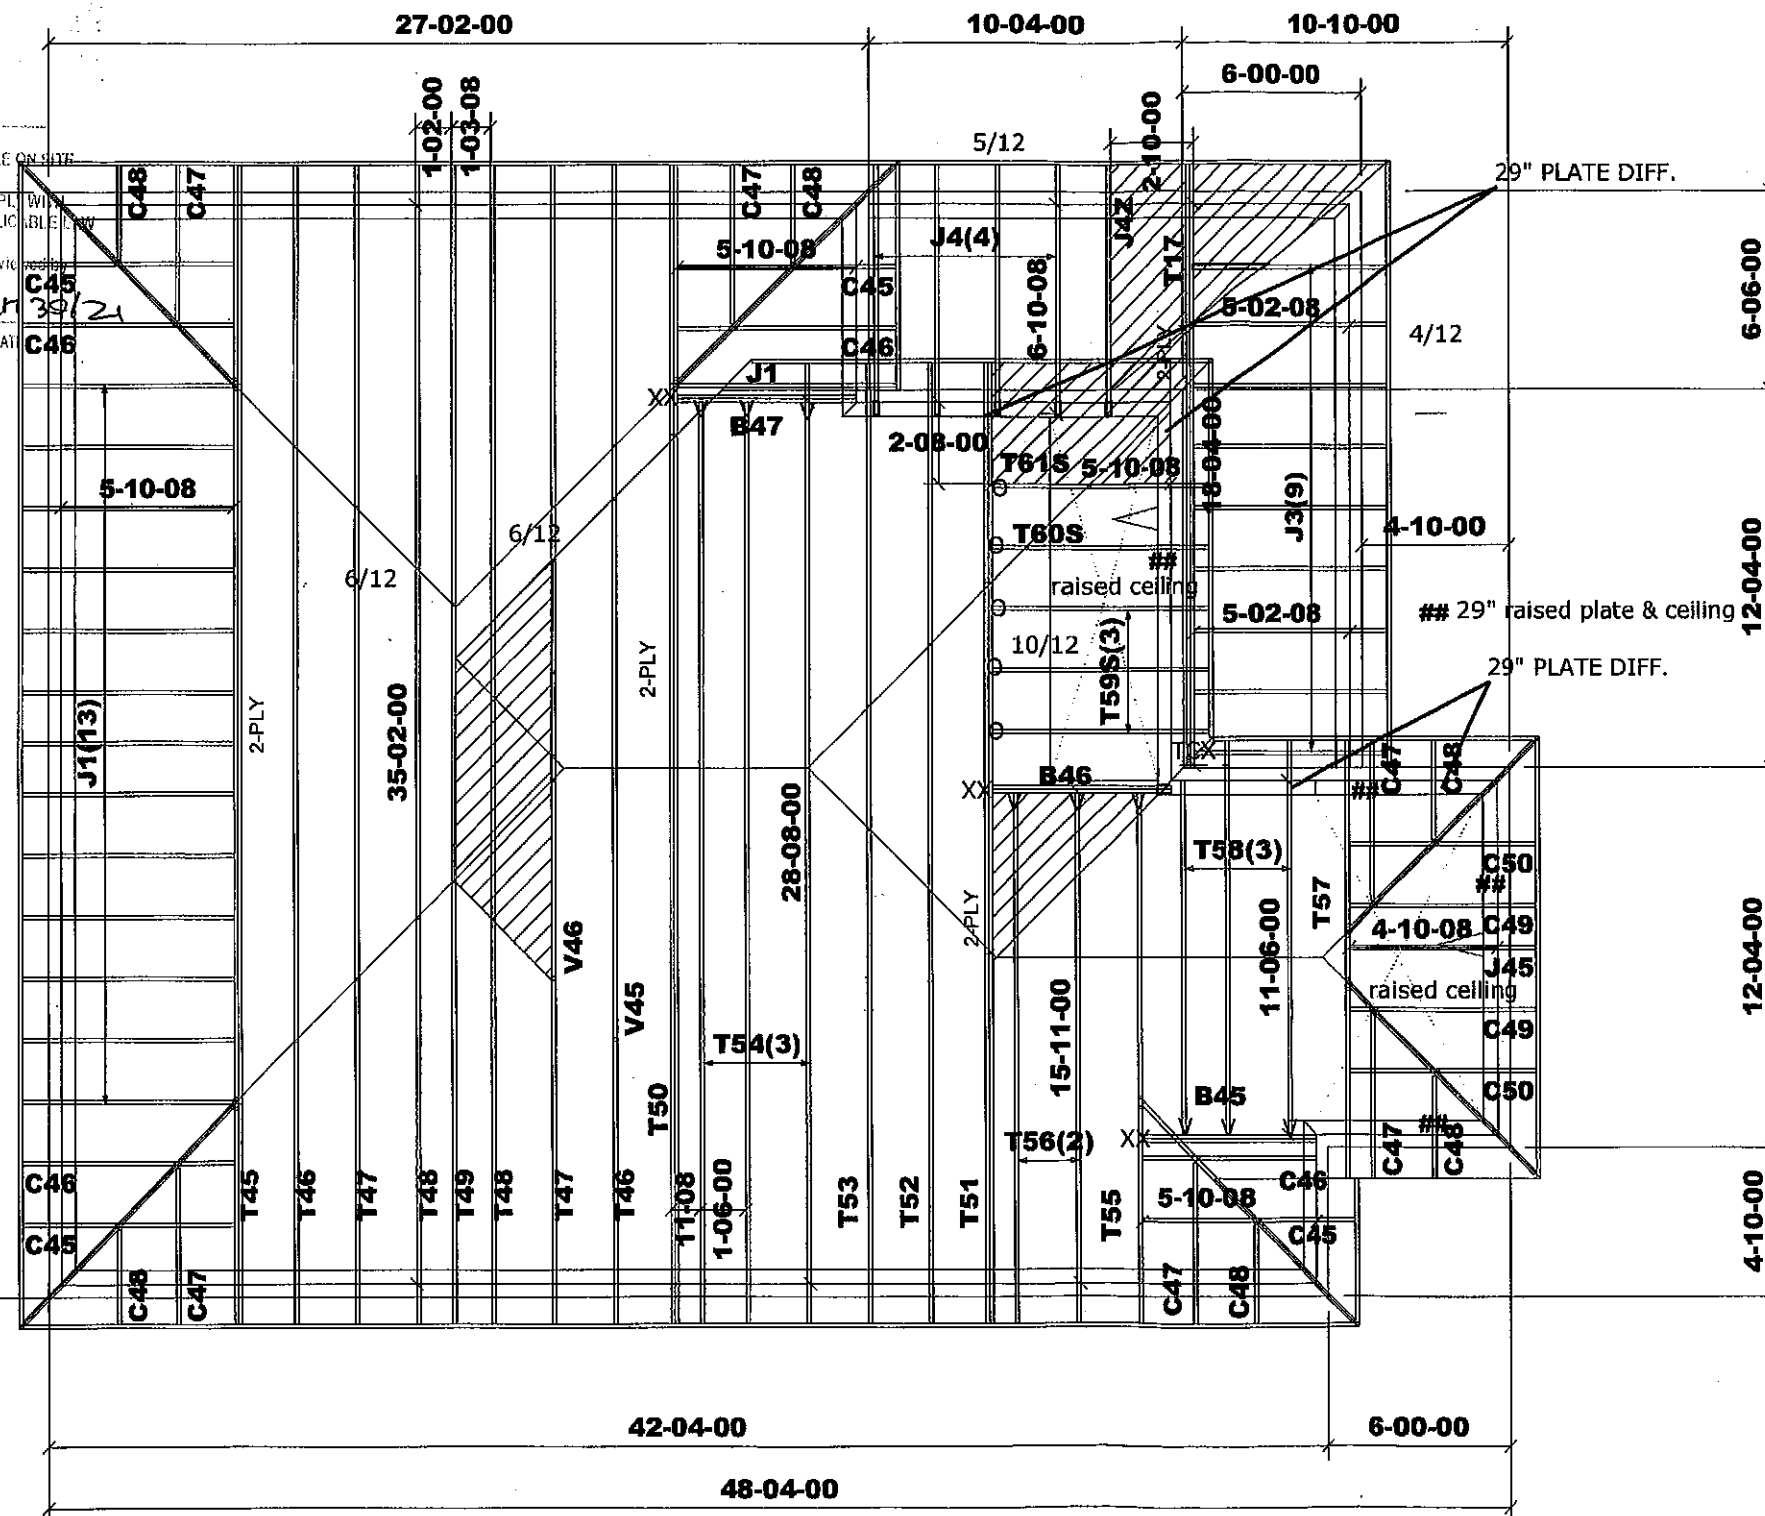

ASPHALT SHINGLES
FINISHED OVERHANG: 12"
2x6 EXTERIOR WALLS
2x6 FASCIA BOARD
HEEL: R.T.M.C.


All conventional framing to conform with
Part 9 of O.B.C. 2012 (2019 amendment).
Roof rafters that cross over or meet trusses
to be min. 2x4 SPF #2 @ 24" o/c with a
vertical post to the truss at each cross
point. Vertical posts longer than 6' to have
lateral bracing so that the distance between
the post end points and lateral bracing does
not exceed 6'.

DESIGN CONFORMS WITH OBC 2012
(2019 amendment) OCCUPANCY:
RESIDENTIAL | PART: 9
Ss = 31.35 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 25.6 psf
TCDL = 6.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)

BEAMS:
B1 = B2 = B3=
2 - 2x10 SPF #2

 DENOTES:
CONVENTIONAL
FRAMING

M13122



Job Track: 51225
Plan Log: 202352
Layout ID: 408039

Builder / Location:
GREEN PARK HOMES / WATERDOWN
Project: **RUSSELL GARDENS PH.3**
Date: 2020-04-27 Sales: Mario DiCano Designer: JG

Model / Elevation:
MOUNTAINASH 1/3







LOT 281


Mitek ver 8.3.1.215

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR
REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY
TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST				Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 1 Lot #: 281 Elevation: 3		Job Track: 51225 PlanLog: 202352 Layout ID: 408039 Ref #: Page: 1 of 3 Date: 04-27-2020 Designer: Sales Rep: Mario DiCano	

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T17 Half Hip Girder	5 /12	18-05-00	2-05-11	2 x 4	1-03-08	5-06 2-00-12	146.31 91.67		
	1 2-ply	T45 Hip Girder	6 /12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	308.58 192.00		
	2	T46 Hip	6 /12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.96 174.00		
	2	T47 Hip	6 /12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.1 174.67		
	2	T48 Hip	6 /12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	289.05 179.67		
	1	T49 Hip	6 /12	35-02-00	7-08-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	148.43 94.67		
	1 2-ply	T50 Roof Special Girder	6 /12	35-02-00	9-06-08	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	350.75 220.67		
	1 2-ply	T51 Hip Girder	6 /12	28-08-00	6-06-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 3-07-00	276.79 172.00		
	1	T52 Hip	6 /12	28-08-00	7-06-04	2 x 4	1-03-08 1-03-08	1-02-00 3-07-00	132.03 82.83		
	1	T53 Hip	6 /12	28-08-00	8-06-04	2 x 4	1-03-08 1-03-08	1-02-00 3-07-00	126.27 79.83		
	3	T54 Common	6 /12	28-08-00	9-06-08	2 x 4	1-03-08	1-02-00 3-07-00	372.41 235.50		
	1	T55 Common Girder	6 /12	15-11-00	6-05-08	2 x 4 2 x 6	1-03-08	1-02-00 3-09-08	76.19 47.17		
	2	T56 Common	6 /12	15-11-00	6-05-08	2 x 4	1-03-08	1-02-00 3-09-08	132.53 84.00		
	1	T57 Hip Girder	6 /12	11-06-00	3-07-04	2 x 4	1-03-08 1-05-00	1-02-00 1-02-00	48.07 32.33		

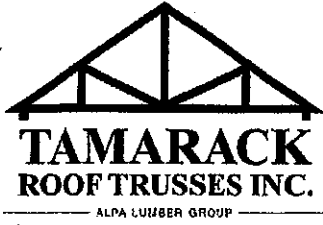

DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 1
 Lot #: 281
 Elevation: 3


Job Track: 51225
 PlanLog: 202352
 Layout ID: 408039
 Ref #
 Page: 2 of 3
 Date: 04-27-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	3	T58 Common	6 /12	11-06-00	6-05-08	2 x 4	1-03-08 1-03-08	3-07-00 3-07-00	160.02 106.00		
	3	T59S Jack-Closed	6 /12	5-10-08	6-06-04	2 x 4	1-03-08	1-02-00 6-06-04	115.98 76.00		
	1	T60S Half Hip	6 /12	5-10-08	5-11-00	2 x 4	1-03-08	1-02-00 5-11-00	39.66 26.17		
	1	T61S Half Hip	6 /12	5-10-08	4-11-00	2 x 4	1-03-08	1-02-00 4-11-00	36.66 24.83		
	1	V45 Valley	6 /12	17-06-00	4-04-08	2 x 4			46.6 29.33		
	1	V46 Valley	6 /12	13-06-00	3-02-00	2 x 4			35.02 22.33		
	14	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	235.1 149.33		
	9	J3 Jack-Open	4 /12	5-02-08	2-05-11	2 x 4	1-03-08	3-15 2-00-12	124.77 78.00		
	4	J4 Jack-Open	5 /12	6-10-08	3-08-10	2 x 4	1-03-08	5-06 3-03-12	85.53 53.33		
	1	J4Z Jack-Open	5 /12	6-10-08	3-08-10	2 x 4	1-03-08	5-06 3-03-12	21.35 13.33		
	1	J45 Jack-Open	6 /12	4-10-08	3-07-04	2 x 4	1-03-08	1-02-00 3-07-04	14.38 9.33		
	4	C45 Jack-Open	6 /12	1-09-08	2-00-12	2 x 4	1-03-08 4-01-00	1-02-00 2-00-12	46.34 29.33		
	4	C46 Jack-Open	6 /12	3-10-15	3-01-08	2 x 4	1-03-08 1-11-09	1-02-00 3-01-08	57.17 34.67		
	6	C47 Jack-Open	6 /12	2-00-00	3-01-08	2 x 4	1-03-08 1-10-15	1-02-00 2-02-00	59.24 36.00		

 TAMARACK ROOF TRUSSES INC. ALFA LUMBER GROUP	DELIVERY SHIPLIST			
	Lumber Yard: TAMARACK LUMBER	Job Track: 51225		
Builder: GREEN PARK HOMES	PlanLog: 202352			
Project: RUSSELL GARDENS PH.3	Layout ID: 408039			
Location: WATERDOWN	Ref #			
Model: MOUNTAINASH 1	Page: 3 of 3			
Lot #: 281	Date: 04-27-2020			
Elevation: 3	Designer:			
	Sales Rep: Mario DiCano			

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	6	C48 Jack-Open	6 /12	1-09-06	2-00-11	2 x 4	1-03-08 1-02	1-02-00 2-00-11	42.1 28.00		
	2	C49 Jack-Open	6 /12	3-10-15	3-01-08	2 x 4	1-03-08 11-09	1-02-00 3-01-08	26.3 16.00		
	2	C50 Jack-Open Girder	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 2-11-09	1-02-00 2-01-08	21.2 13.33		

TOTAL # TRUSS= 87

TOTAL BFT OF ALL TRUSSES= 2606.32 BFT.

TOTAL WEIGHT OF ALL TRSSES 4129.87 LBS

HARDWARE


QTY	TYPE	MODEL	LENGTH
3	Hardware	HGUS26-2	
9	Hardware	LJS26DS	
5	Hardware	LUS24	

TOTAL NUMBER OF
ITEMS=

17

JOB NAME 408016	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 13:20:57 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-YNzkWISWY4Ch5G03aUPmp43X6qrMM2PJ?R12rKzNVs4

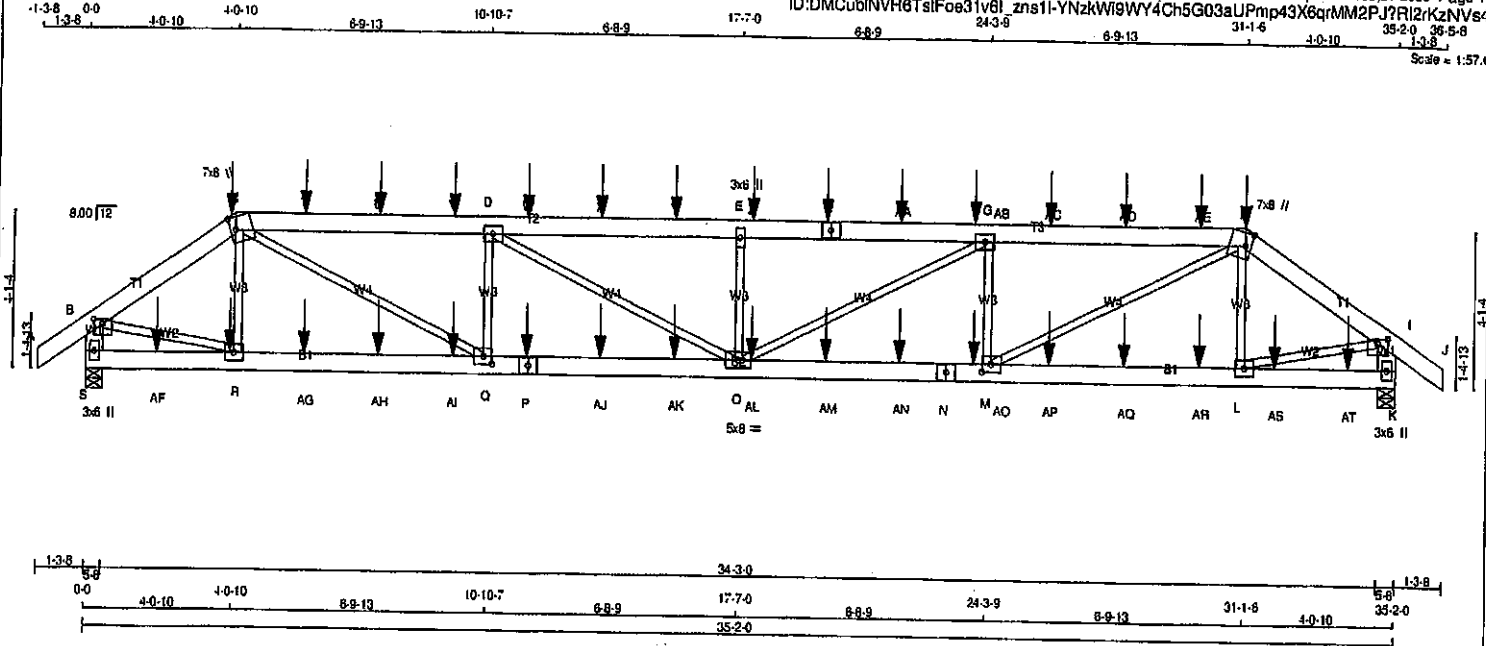

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x6	DRY	No.2	SPF
C - F	2x6	DRY	No.2	SPF
F - H	2x6	DRY	No.2	SPF
H - J	2x6	DRY	No.2	SPF
J - L	2x6	DRY	No.2	SPF
L - P	2x6	DRY	No.2	SPF
P - N	2x6	DRY	No.2	SPF
N - K	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C 2	12	SIDE(122.0)
C-F 2	12	SIDE(61.0)
F-H 2	12	SIDE(61.0)
H-J 2	12	SIDE(122.0)
J-L 2	12	TOP
L-P 2	12	TOP
P-N 2	12	SIDE(183.1)
N-K 2	12	SIDE(0.0)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT 3397 0	DOWN 3397 0	5-8	5-8
S	HORZ 0	HORZ 0	5-8	5-8
K	UPLIFT 0	UPLIFT 0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED SNOW LIVE PERMLIVE WIND DEAD SOIL
S	2400 1588 0 0 0 0 812 0 0 0
K	2366 1557 0 0 0 0 809 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.02 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 36	-91.8	-91.8	0.04 (1)	10.00	R-C	-517 0 0.06 (1)
B-C	-4153 0	-91.8	-91.8	0.09 (1)	5.52	C-Q	0 3919 0.49 (1)
C-T	-6892 0	-91.8	-91.8	0.33 (1)	4.29	Q-D	-1649 0 0.20 (1)
T-U	-6892 0	-91.8	-91.8	0.33 (1)	4.29	D-O	0 1172 0.15 (1)
U-V	-6892 0	-91.8	-91.8	0.33 (1)	4.29	O-E	-916 0 0.11 (1)
V-D	-6892 0	-91.8	-91.8	0.33 (1)	4.29	E-G	0 1203 0.15 (1)
D-W	-7922 0	-91.8	-91.8	0.36 (1)	4.02	G-M	-1670 0 0.20 (1)
W-X	-7922 0	-91.8	-91.8	0.36 (1)	4.02	M-H	0 3962 0.49 (1)
X-Y	-7922 0	-91.8	-91.8	0.36 (1)	4.02	H-I	-500 0 0.06 (1)
Y-E	-7922 0	-91.8	-91.8	0.36 (1)	4.02	E-R	0 3526 0.44 (1)
E-Z	-7922 0	-91.8	-91.8	0.36 (1)	4.02	L-I	0 3458 0.43 (1)
Z-F	-7922 0	-91.8	-91.8	0.36 (1)	4.02		
F-AA	-7922 0	-91.8	-91.8	0.36 (1)	4.02		
AA-AB	-7922 0	-91.8	-91.8	0.36 (1)	4.02		
AB-G	-7922 0	-91.8	-91.8	0.36 (1)	4.02		
G-AC	-6865 0	-91.8	-91.8	0.33 (1)	4.30		
AC-AD	-6865 0	-91.8	-91.8	0.33 (1)	4.30		
AD-AE	-6865 0	-91.8	-91.8	0.33 (1)	4.30		
AE-H	-6865 0	-91.8	-91.8	0.33 (1)	4.30		
H-I	-4073 0	-91.8	-91.8	0.09 (1)	5.58		
I-J	0 36	-91.8	-91.8	0.04 (1)	10.00		
S-B	-3377 0	0.0	0.0	0.12 (1)	7.58		
K-I	-3318 0	0.0	0.0	0.12 (1)	7.63		

S-AF	0 0	-18.5	-18.5	0.07 (4)	10.00
AF-R	0 0	-18.5	-18.5	0.07 (4)	10.00
R-AG	0 3431	-18.5	-18.5	0.27 (1)	10.00
AG-AH	0 3431	-18.5	-18.5	0.27 (1)	10.00
AH-AI	0 3431	-18.5	-18.5	0.27 (1)	10.00
AI-Q	0 3431	-18.5	-18.5	0.27 (1)	10.00
Q-P	0 6892	-18.5	-18.5	0.52 (1)	10.00
P-AJ	0 6892	-18.5	-18.5	0.52 (1)	10.00
AJ-AK	0 6892	-18.5	-18.5	0.52 (1)	10.00
AK-O	0 6892	-18.5	-18.5	0.52 (1)	10.00
O-AL	0 6865	-18.5	-18.5	0.51 (1)	10.00
AL-AM	0 6865	-18.5	-18.5	0.51 (1)	10.00
AM-AN	0 6865	-18.5	-18.5	0.51 (1)	10.00
AN-N	0 6865	-18.5	-18.5	0.51 (1)	10.00
N-AO	0 6865	-18.5	-18.5	0.51 (1)	10.00
AO-M	0 6865	-18.5	-18.5	0.51 (1)	10.00
M-AP	0 3388	-18.5	-18.5	0.27 (1)	10.00
AP-AQ	0 3388	-18.5	-18.5	0.27 (1)	10.00
AQ-AR	0 3388	-18.5	-18.5	0.27 (1)	10.00

TOTAL WEIGHT = 2 X 181 = 361 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = L/999 (0.20)
ALLOWABLE DEFL.(TL) = L/360 (1.17)
CALCULATED VERT. DEFL.(TL) = L/999 (0.38)

CSI: TC=0.35/1.00 (D-E:1), BC=0.52/1.00 (O-Q:1), WB=0.49/1.00 (H-M:1), SS=0.20/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (M) (INPUT = 0.90)
JSI METAL= 0.63 (P) (INPUT = 1.00)

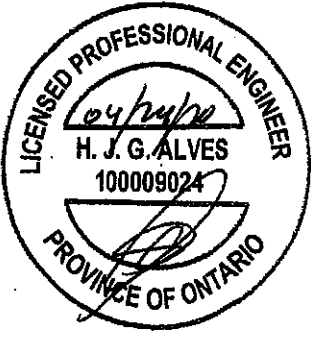

Structural component only
DWG# T-2006875 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408016	T1	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 24 13:20:57 2020 Page 2
ID:DMCubINVR6TstFoe31v6l zns1t-YNzkW9WY4Ch5G03aUPmp43X6arMM2PJ7Ri2rKzNVs4

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	8.0	1.50 3.00
C	TTWW-m	MT20	7.0	8.0	4.00 1.75
D	TMVW-l	MT20	5.0	8.0	
E	TMVW-w	MT20	3.0	8.0	
F	TS-l	MT20	5.0	8.0	
G	TMVW-l	MT20	5.0	8.0	
H	TTWW-m	MT20	7.0	8.0	4.00 1.75
I	TMVW-p	MT20	5.0	8.0	1.50 3.00
K	BMV1-p	MT20	3.0	8.0	
L	BMVW-l	MT20	5.0	8.0	
M	BMVW-l	MT20	5.0	8.0	2.50 2.75
N	BS-l	MT20	5.0	8.0	
O	BMVWW-l	MT20	5.0	8.0	
P	BS-l	MT20	5.0	8.0	
Q	BMVW-l	MT20	5.0	8.0	2.50 2.75
R	BMVW-l	MT20	5.0	8.0	
S	BMV1-p	MT20	3.0	8.0	

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO	LENGTH	FR-TO			
AP-L	0 3368	-18.5 -18.5	0.27 (1)	10.00			
L-AS	0 0	-18.5 -18.5	0.07 (4)	10.00			
AS-AT	0 0	-18.5 -18.5	0.07 (4)	10.00			
AT-K	0 0	-18.5 -18.5	0.07 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)


JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-10	-49	-55	---	FRONT	VERT	DEAD	---	C1
C	4-0-10	-117	-117	---	BACK	VERT	TOTAL	---	C1
C	4-0-10	-254	-254	---	FRONT	VERT	SNOW	---	C1
F	19-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
H	31-1-6	-49	-55	---	FRONT	VERT	DEAD	---	C1
H	31-1-6	-254	-254	---	FRONT	VERT	SNOW	---	C1
P	11-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
R	3-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
T	5-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	7-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	9-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	11-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
X	13-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
Y	15-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
Z	17-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AA	21-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AB	23-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AC	25-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AD	27-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AE	29-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AF	1-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AG	5-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AH	7-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AI	9-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AJ	13-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AK	15-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AL	17-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AM	19-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AN	21-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AO	23-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AP	25-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AQ	27-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AR	29-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AS	31-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AT	33-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2006875 12

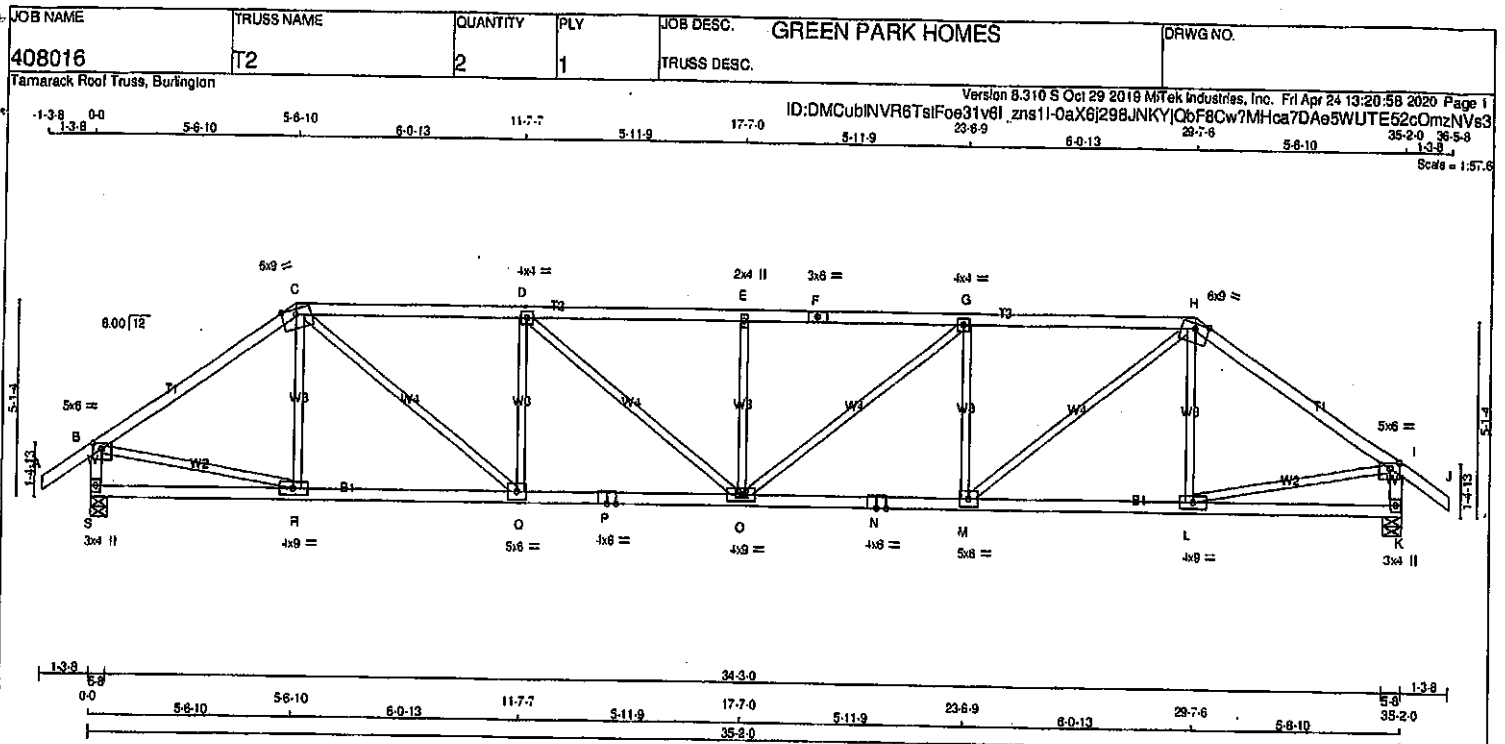

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
S - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
S - P	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

ORY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TTWW-m	MT20	6.0	9.0	Edge	
D	TMVW-l	MT20	4.0	4.0		
E	TMVW-w	MT20	2.0	4.0		
F	TS-l	MT20	3.0	6.0		
G	TMVW-l	MT20	4.0	4.0		
H	TTWW-m	MT20	6.0	9.0	Edge	
I	TMVW-p	MT20	5.0	6.0	1.75	2.75
K	BMV1+p	MT20	3.0	4.0		
L	BMVW-l	MT20	4.0	9.0		
M	BMVW-l	MT20	5.0	6.0		
N	BS-l	MT20	4.0	6.0		
O	BMVW-w-l	MT20	4.0	9.0		
P	BS-l	MT20	4.0	6.0		
Q	BMVW-l	MT20	5.0	6.0		
R	BMVW-l	MT20	4.0	9.0		
S	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORIZ		
S	2085	0	2085	0	5-8	5-8
K	2085	0	2085	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM. LIVE	IN-SX			
S	1458	970	0	0	0	488	0
K	1458	970	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

MEMB.	CHORDS			WEBS		
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. CSI (LC)	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		FR-TO		
A-B	0 35	-91.8 -91.8 0.12 (1)	10.00	R-C	-243. 10	0.09 (1)
B-C	-2297 0	-91.8 -91.8 0.70 (1)	3.78	C-Q	0 1670	0.38 (1)
C-D	-3214 0	-91.8 -91.8 0.86 (1)	3.18	Q-D	-929 0	0.36 (1)
D-E	-3595 0	-91.8 -91.8 0.86 (1)	2.97	D-O	0 490	0.11 (1)
E-F	-3595 0	-91.8 -91.8 0.86 (1)	2.97	O-E	-505 0	0.19 (1)
F-G	-3595 0	-91.8 -91.8 0.86 (1)	3.18	O-G	0 490	0.11 (1)
G-H	-3214 0	-91.8 -91.8 0.86 (1)	3.18	M-G	-929 0	0.36 (1)
H-I	-2297 0	-91.8 -91.8 0.12 (1)	10.00	L-H	0 1670	0.38 (1)
I-J	0 35	-91.8 -91.8 0.70 (1)	3.78	H-R	-243 10	0.09 (1)
S-B	-2023 0	0.0 0.0 0.21 (1)	5.94	B-R	0 1943	0.44 (1)
K-I	-2023 0	0.0 0.0 0.21 (1)	5.94	L-I	0 1943	0.44 (1)
S-R	0 0	-18.5 -18.5 0.15 (4)	10.00			
R-Q	0 1904	-18.5 -18.5 0.39 (1)	10.00			
Q-P	0 3214	-18.5 -18.5 0.58 (1)	10.00			
P-O	0 3214	-18.5 -18.5 0.58 (1)	10.00			
O-N	0 3214	-18.5 -18.5 0.58 (1)	10.00			
N-M	0 3214	-18.5 -18.5 0.58 (1)	10.00			
M-L	0 1904	-18.5 -18.5 0.39 (1)	10.00			
L-K	0 0	-18.5 -18.5 0.15 (4)	10.00			

TOTAL WEIGHT = 2 X 140 = 280 lb

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.39")

CSK TC=0.88/1.00 (E-G:1), BC=0.58/1.00 (O-Q:1), WB=0.44/1.00 (B-R:1), SS=0.28/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (B) (INPUT = 0.90)
JSI METAL= 0.74 (P) (INPUT = 1.00)




Structural component only
DWG# T-2006876

JOB NAME 408016	TRUSS NAME T3	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TAMARACK ROOF TRUSS, BURLINGTON				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Fri Apr 24 13:20:59 2020 Page 1

ID:DMCubINVR6TsiFoe31v6l_zns11-Um5VxOAm4hSPLa9RhvREvV8qWdYHggTcTIn9wDzNVs2

Scale = 1:57.6

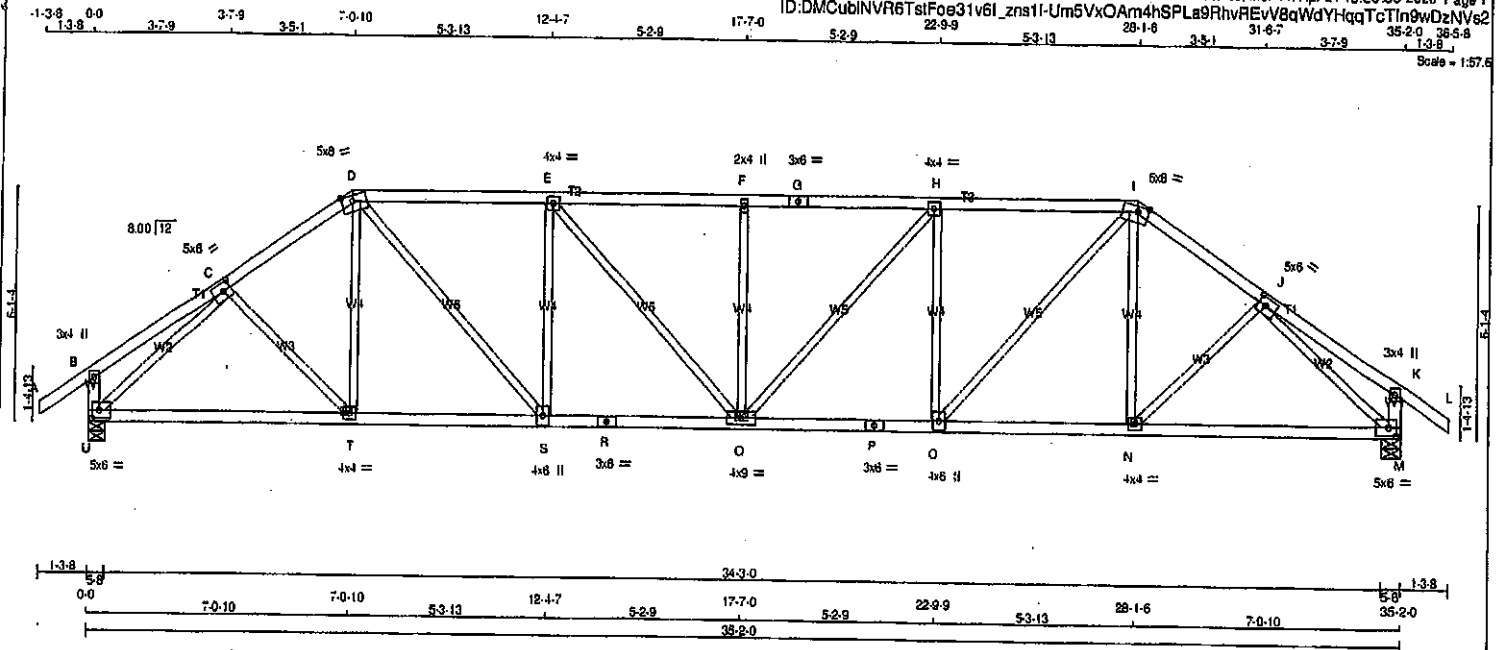

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
I - L	2x4	DRY	No.2	SPF
U - B	2x4	DRY	No.2	SPF
M - K	2x4	DRY	No.2	SPF
U - R	2x4	DRY	No.2	SPF
R - P	2x4	DRY	No.2	SPF
P - M	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	0	0
U	HORZ	UP/LFT	5-8	5-8
M	HORZ	UP/LFT	5-8	5-8

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED SNOW LIVE PERM LIVE WIND DEAD SOIL
U	1458 970 0 0 0 0 0 0 0 0
M	1458 970 0 0 0 0 0 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.53 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.
FR-TO				FR-TO			
A-B	0.35	-91.8	0.12 (1)	10.00	C-T	0.135	0.03 (4)
B-C	0.18	-91.8	0.16 (1)	10.00	T-D	0.90	0.03 (4)
C-D	-2308 0	-91.8	0.23 (1)	4.31	D-S	0.1218	0.27 (1)
D-E	-2724 0	-91.8	0.54 (1)	3.69	S-E	-814 0	0.48 (1)
E-F	-2967 0	-91.8	0.58 (1)	3.53	E-Q	0.383	0.08 (1)
F-G	-2967 0	-91.8	0.58 (1)	3.53	Q-F	-440 0	0.28 (1)
G-H	-2967 0	-91.8	0.58 (1)	3.53	H-Q	0.383	0.08 (1)
H-I	-2724 0	-91.8	0.54 (1)	3.69	Q-H	-814 0	0.48 (1)
I-J	-2308 0	-91.8	0.23 (1)	4.31	O-I	0.1218	0.27 (1)
J-K	0.18	-91.8	0.16 (1)	10.00	N-I	0.90	0.03 (4)
K-L	0.35	-91.8	0.12 (1)	10.00	N-J	0.135	0.03 (4)
U-B	-255 0	0.0	0.03 (1)	7.81	U-C	-2515 0	0.97 (1)
M-K	-255 0	0.0	0.03 (1)	7.81	J-M	-2515 0	0.97 (1)
U-T	0 1802	-18.5	-18.5 0.40 (1)	10.00			
T-S	0 1901	-18.5	-18.5 0.41 (1)	10.00			
S-R	0 2724	-18.5	-18.5 0.49 (1)	10.00			
R-Q	0 2724	-18.5	-18.5 0.49 (1)	10.00			
Q-P	0 2724	-18.5	-18.5 0.49 (1)	10.00			
P-O	0 2724	-18.5	-18.5 0.49 (1)	10.00			
O-N	0 1901	-18.5	-18.5 0.41 (1)	10.00			
N-M	0 1802	-18.5	-18.5 0.40 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")

CALCULATED VERT. DEFL.(LL) = L/999 (0.16")

ALLOWABLE DEFL.(TL) = L/360 (1.17")

CALCULATED VERT. DEFL.(TL) = L/999 (0.29")

CSI: TC=0.56/1.00 (E-F:1), BC=0.49/1.00 (Q-S:1), WB=0.97/1.00 (C-U:1), SS=0.23/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PS) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 618 354 1667 768 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (U) (INPUT = 0.90)

JSI METAL = 0.84 (P) (INPUT = 1.00)

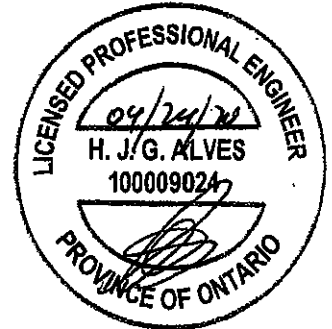

Structural component only
DWG# T-2006877

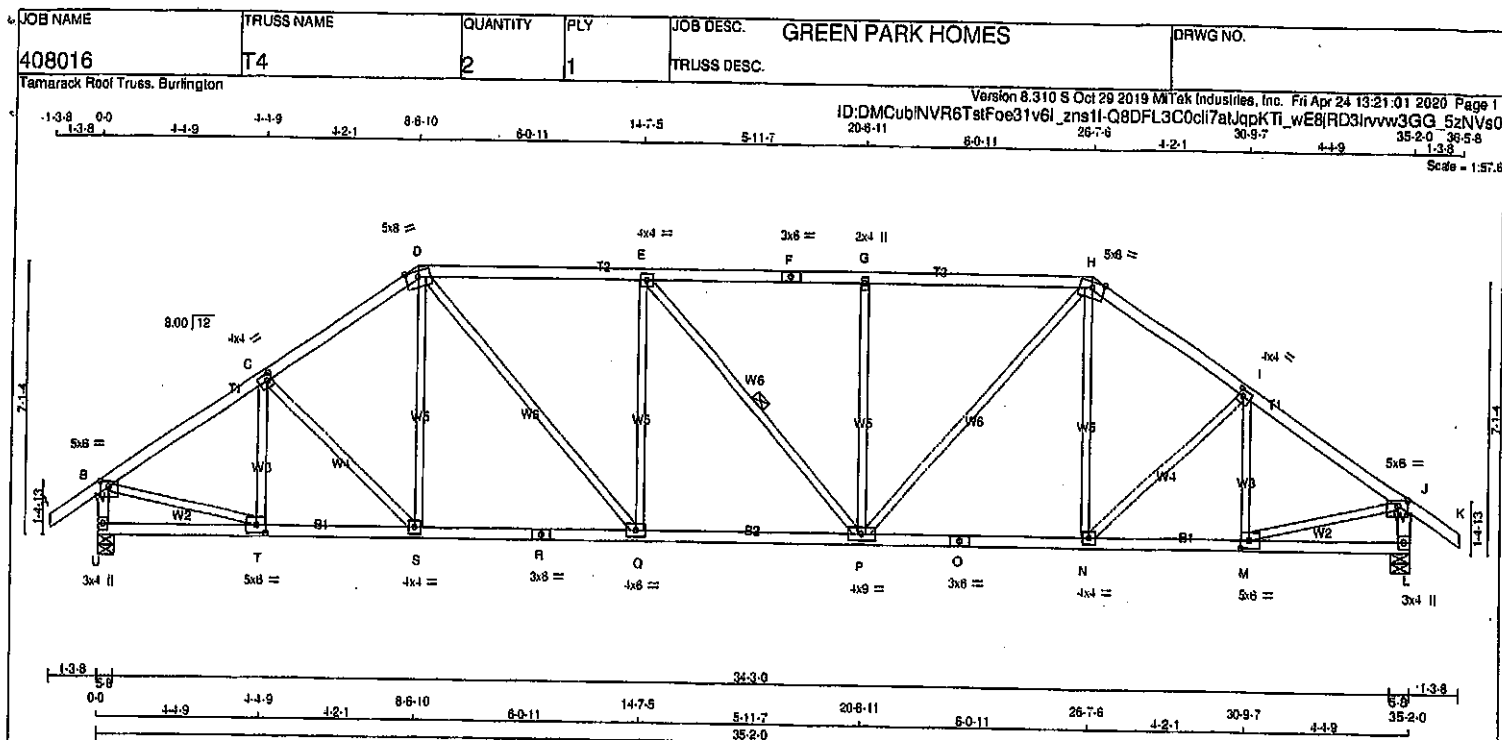

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
A - D	2x4	DRY No.2
D - F	2x4	DRY No.2
F - H	2x4	DRY No.2
H - K	2x4	DRY No.2
U - B	2x4	DRY No.2
L - J	2x4	DRY No.2
U - R	2x4	DRY No.2
R - O	2x4	DRY No.2
O - L	2x4	DRY No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.75	2.75
C	TMVW-i	MT20	4.0	4.0	2.00	1.50
D	TTVW-m	MT20	5.0	8.0	Edge	
E	TMVW-i	MT20	4.0	4.0		
F	TS-i	MT20	3.0	6.0		
G	TMVW-w	MT20	2.0	4.0		
H	TTVW-m	MT20	5.0	8.0	Edge	
I	TMVW-i	MT20	4.0	4.0	2.00	1.50
J	TMVW-p	MT20	5.0	8.0	1.75	2.75
L	BMV1-p	MT20	3.0	4.0		
M	BMVW-i	MT20	5.0	6.0	2.50	2.75
N	BMVW-i	MT20	4.0	4.0		
O	BS-i	MT20	3.0	6.0		
P	BMVW-i	MT20	4.0	9.0		
Q	BMVW-i	MT20	4.0	6.0		
R	BS-i	MT20	3.0	6.0		
S	BMVW-i	MT20	4.0	4.0		
T	BMVW-i	MT20	5.0	8.0	2.50	2.75
U	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECORD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
U	2065	0	2065	0	5-8	5-8
L	2065	0	2065	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
U	1458	970	0	0	0	0	0
L	1458	970	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0.35	-91.8	-91.8	0.12 (1)	10.00	T-C	-398.0 0.11 (1)
B-C	-2270 0	-91.8	-91.8	0.37 (1)	4.19	C-S	-79 0 0.05 (1)
C-D	-2254 0	-91.8	-91.8	0.38 (1)	4.21	S-D	0 156 0.04 (4)
D-E	-2485 0	-91.8	-91.8	0.64 (1)	3.72	D-Q	0 949 0.21 (1)
E-F	-2484 0	-91.8	-91.8	0.64 (1)	3.72	Q-E	-597 0 0.52 (1)
F-G	-2484 0	-91.8	-91.8	0.64 (1)	3.72	E-P	-2 0 0.00 (1)
G-H	-2484 0	-91.8	-91.8	0.63 (1)	3.71	P-G	-597 0 0.52 (1)
H-I	-2254 0	-91.8	-91.8	0.38 (1)	4.24	P-H	0 947 0.21 (1)
I-J	-2270 0	-91.8	-91.8	0.37 (1)	4.19	N-H	0 157 0.04 (4)
J-K	0.35	-91.8	-91.8	0.12 (1)	10.00	N-I	-78 0 0.05 (1)
U-B	-2027 0	0.0	0.0	0.21 (1)	5.94	M-I	-397 0 0.11 (1)
L-J	-2066 0	0.0	0.0	0.21 (1)	5.94	B-T	0 1966 0.44 (1)
						M-J	0 1966 0.44 (1)
U-T	0 0	-18.5	-18.5	0.08 (4)	10.00		
T-S	0 1909	-18.5	-18.5	0.37 (1)	10.00		
S-R	0 1854	-18.5	-18.5	0.38 (1)	10.00		
R-Q	0 1854	-18.5	-18.5	0.38 (1)	10.00		
Q-P	0 2485	-18.5	-18.5	0.47 (1)	10.00		
P-O	0 1854	-18.5	-18.5	0.38 (1)	10.00		
O-N	0 1854	-18.5	-18.5	0.38 (1)	10.00		
N-M	0 1909	-18.5	-18.5	0.37 (1)	10.00		
M-L	0 0	-18.5	-18.5	0.08 (4)	10.00		

TOTAL WEIGHT = 2 X 155 = 309 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.64/1.00 (D-E:1), BC=0.47/1.00 (P-Q:1),
WB=0.52/1.00 (E-Q:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (PSI) SHEAR SECTION (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (I) (INPUT = 0.90)
JSI METAL = 0.62 (I) (INPUT = 1.00)




Structural component only
DWG# T-2006878

JOB NAME 408016	TRUSS NAME T6	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 24 13:21:03 2020 Page 1
 ID:DMCubINVR6TstFoe31v61_zns11-MXL?mIDH8wyqBTDWwA3LJZQE4m3COMIM3_zNVs
 24-7-6 27-10-6 28-9-8 30-8-12 31-1-6 35-2-0 38-5-8
 1-3-8 0-0 9-10 1-3-8 8-10 3-3-0 4-0-10 10-3-6 14-4-0 10-3-6 24-7-6 3-3-0 11-2 1-11-4 4-10 4-0-10 1-3-8

Scale = 1:67.0

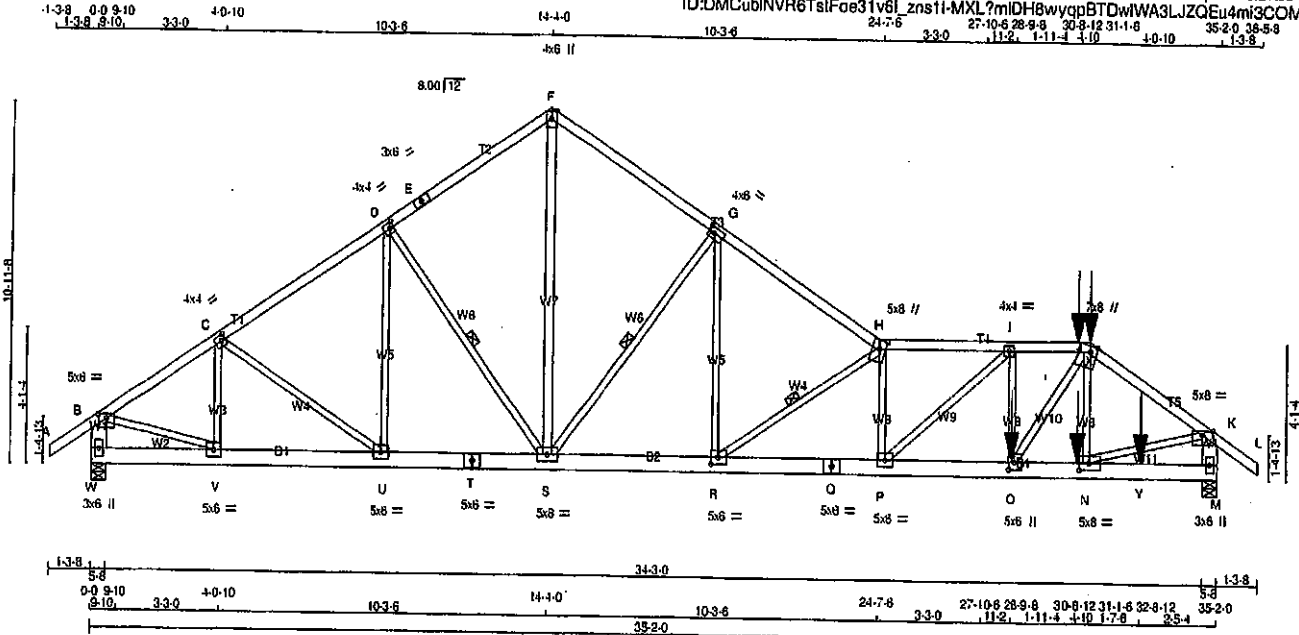

LUMBER	SIZE	DRY	LUMBER	DESCR.
N.L.G.A. RULES				
CHORDS				
A - E	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
J - L	2x4	DRY	No.2	SPF
W - B	2x6	DRY	No.2	SPF
M - K	2x6	DRY	No.2	SPF
T - Q	2x6	DRY	No.2	SPF
Q - M	2x6	DRY	No.2	SPF
ALL WEBS EXCEPT S - F	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-E 1 12	TOP	
F-H 1 12	TOP	
J-L 1 12	TOP	
W-B 2 12	TOP	
M-K 2 12	TOP	
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
W-T 2 12	TOP	
T-Q 2 12	TOP	
Q-M 2 12	TOP	
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1 6	SIDE(183.1)	
1-0 1 3	SIDE(183.1)	
2x4 1 6	SIDE(183.1)	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.



Structural component only
 DWG# T-2006880

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REORD	
JT	GROSS REACTION	DOWN	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
W	2636	0	0	2636	0	0	5-8	5-8	5-8
M	4822	0	0	4822	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST LCASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
W	1880	1245	0	0	0
M	3399	2286	0	0	0

BEARING MATERIAL TO 8E SPF NO.2 OR BETTER AT JOINT(S) W, M

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.33 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-S, G-S, H-R.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
 TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD	MAX. CSI (LC)	MEMB.	FORCE (LBS)
FR-TO		FROM TO		FR-TO	
A-B	0 35	-91.8 -91.8 0.07 (1)	10.00	U-D	0 84
B-C	-3018 0	-91.8 -91.8 0.17 (1)	5.16	O-S	-464 0
C-D	-3139 0	-91.8 -91.8 0.27 (1)	4.99	S-F	0 2758
D-E	-2847 0	-91.8 -91.8 0.25 (1)	5.19	S-G	-2760 0
E-F	-2847 0	-91.8 -91.8 0.25 (1)	5.19	R-G	0 2720
F-G	-2851 0	-91.8 -91.8 0.28 (1)	5.15	R-H	-4488 0
G-H	-4733 0	-91.8 -91.8 0.37 (1)	4.13	P-H	-374 0
H-I	-7591 0	-91.8 -91.8 0.34 (1)	3.33	N-J	-953 0
I-X	-7094 0	-91.8 -91.8 0.23 (1)	3.53	B-V	0 2607
X-J	-7094 0	-91.8 -91.8 0.23 (1)	3.53	M-K	0 5051
J-K	-5913 0	-91.8 -91.8 0.30 (1)	3.79	O-I	-764 0
K-L	0 35	-91.8 -91.8 0.07 (1)	10.00	O-J	0 4164
W-B	-2590 0	0.0 0.0 0.09 (1)	7.81	P-C	0 675
M-K	-4782 0	0.0 0.0 0.17 (1)	6.62	V-C	-589 0
W-V	0 0	-18.5 -18.5 0.02 (1)	10.00	C-U	0 111
V-U	0 2528	-18.5 -18.5 0.20 (1)	10.00		
U-T	0 2619	-18.5 -18.5 0.21 (1)	10.00		
T-S	0 2619	-18.5 -18.5 0.21 (1)	10.00		
S-R	0 3989	-18.5 -18.5 0.30 (1)	10.00		
R-Q	0 7602	-18.5 -18.5 0.58 (1)	10.00		
Q-P	0 7602	-18.5 -18.5 0.58 (1)	10.00		
P-O	0 7083	-18.5 -18.5 0.55 (1)	10.00		
O-N	0 4885	-18.5 -18.5 0.40 (1)	10.00		
N-Y	0 0	-18.5 -18.5 0.03 (4)	10.00		
Y-M	0 0	-18.5 -18.5 0.03 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)		LOC.		MAX.		FACE		DIR.		HEEL		CONN.	
JT	LOC.	LC1	MAX.	MAX.	MAX.	MAX.	MAX.	MAX.	MAX.	MAX.	MAX.	MAX.	MAX.
J	31-1-6	-49	-55	---	---	---	---	---	---	---	---	---	C1
J	31-1-6	-252	-252	---	---	---	---	---	---	---	---	---	C1
N	30-8-12	-26	-26	---	---	---	---	---	---	---	---	---	C1
O	28-9-8	-2837	-2837	---	---	---	---	---	---	---	---	---	C1
X	30-8-12	-139	-139	---	---	---	---	---	---	---	---	---	C1
Y	32-8-12	-26	-26	---	---	---	---	---	---	---	---	---	C1

TOTAL WEIGHT = 2 X 187 = 374 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
 GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
 LOADS WERE DERIVED FROM USER INPUT
 NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 0.0 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.0/12

*** NON STANDARD GIRDER ***
 ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBCC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.18")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.33")

CSI: TC=0.37 1.00 (G-H:1), BC=0.59 1.00 (P-R:1), WB=0.74 1.00 (G-S:1), SS=0.10 1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES		PLATE GRIP(DRY)		SHEAR		SECTION	
(PSI)	(PLI)	(PSI)	(PLI)	(PSI)	(PLI)	(PSI)	(PLI)
MT20	618	354	1867	788	1987	886	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (G) (INPUT = 0.90)
 JSI METAL = 0.73 (Q) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408016	T6	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 24 13:21:03 2020 Page 2
ID:DMCubINVR6TstFoe31v6I zns1I-MXL?mlDHBwvqpBTDwWA3LJZOEu4mi3COMIM3 zNVs

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.50	3.00
C	TMWW-I	MT20	4.0	4.0	2.00	1.50
D	TMWW-I	MT20	4.0	4.0	2.00	1.50
E	TS-I	MT20	3.0	6.0		
F	TTW+p	MT20	4.0	6.0	Edge	
G	TMWW-I	MT20	4.0	6.0	2.00	2.25
H	TTWW+m	MT20	5.0	8.0	3.25	2.25
I	TMWW-I	MT20	4.0	4.0		
J	TTWW+m	MT20	7.0	8.0	Edge	2.50
K	TMVW-p	MT20	5.0	8.0	Edge	
M	BMV1+p	MT20	3.0	6.0		
N	BMWW-I	MT20	5.0	8.0	2.50	3.75
O	BMWW-I	MT20	5.0	8.0	2.75	2.25
P, U, V						
P	BMWW-I	MT20	5.0	6.0		
O	BS-I	MT20	5.0	8.0		
R	BMWW-I	MT20	5.0	6.0	2.50	2.75
S	BMWW-I	MT20	5.0	8.0		
T	BS-I	MT20	5.0	6.0		
W	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2006880 42

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408016	T7	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310.5 Oct 29 2019
Mitek Industries, Inc.
Fri Apr 24 13:21:04 2020
Page 1
ID:DMCubINVR6TsFos31v6I_zns11-qjuN_5EwD4hRL2PUS1PcYsameGIVd4Lc0VvaQzNVrz
17-6-12 19-6-2 18-8-12 20-9-12 22-9-8 25-7-8 28-4-8 28-0-0 29-11-8 28-1-3-8
9-8-2-10 2-0-0 2-0-12 2-10-0 2-9-0 3-8-1-3-8
Scale: 1/4"=1'-1"

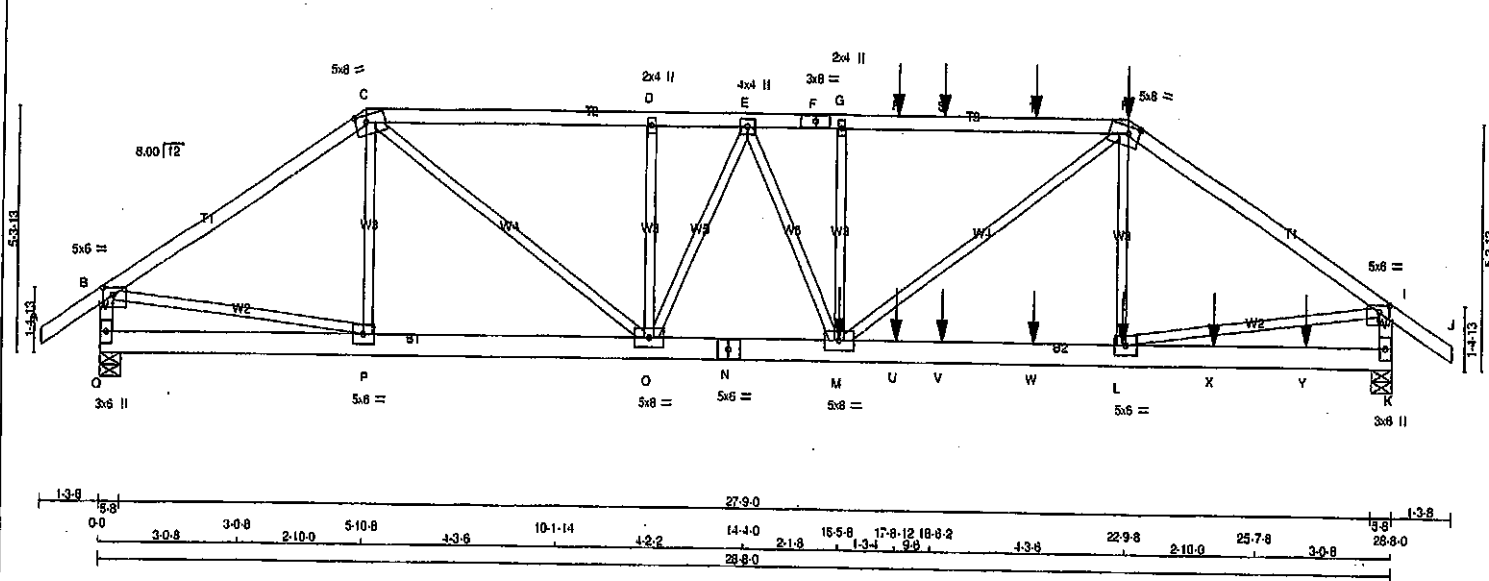

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
Q - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
Q - N	2x6	DRY	No.2
N - K	2x6	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS	#ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS			
A - C	1	12	TOP
C - F	1	12	TOP
F - H	1	12	SIDE(81.0)
H - J	1	12	SIDE(81.0)
Q - B	1	12	TOP
K - I	1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS			
Q - N	2	12	TOP
N - K	2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS			
L - H	1	6	SIDE(11.5)
G - M	1	6	SIDE(327.9)
2x3	1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	
Q	2875 0	2875 0	0 5-8	0 5-8	
K	3757 0	3757 0	0 5-8	0 5-8	

UNFACTORED REACTIONS					
JT	1ST LCASE COMBINED	MAX. MIN. COMPONENT REACTIONS			
Q	2027 1368 0	0 0	0 0	0 0	0 0
K	2651 1771 0	0 0	0 0	0 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS Q, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0.35	-91.8 -91.8 0.07 (1)	10.00	P-C	-348 0	0.07 (1)	
B-C	-3505 0	-91.8 -91.8 0.43 (1)	4.80	C-O	0 2893	0.38 (1)	
C-D	-5189 0	-91.8 -91.8 0.47 (1)	3.89	O-D	-877 0	0.14 (1)	
D-E	-5189 0	-91.8 -91.8 0.35 (1)	3.89	M-G	-1219 0	0.25 (1)	
E-F	-6254 0	-91.8 -91.8 0.67 (1)	3.00	M-H	0 2943	0.36 (1)	
F-G	-6254 0	-91.8 -91.8 0.67 (1)	3.00	L-H	-368 68	0.07 (1)	
G-R	-6253 0	-91.8 -91.8 0.91 (1)	3.00	L-I	0 3993	0.49 (1)	
R-S	-6253 0	-91.8 -91.8 0.91 (1)	3.00	B-E	0 2853	0.37 (1)	
S-T	-6253 0	-91.8 -91.8 0.91 (1)	3.00	O-E	-1091 0	0.28 (1)	
T-H	-6253 0	-91.8 -91.8 0.91 (1)	3.00	E-M	0 1605	0.20 (1)	
H-I	-4739 0	-91.8 -91.8 0.53 (1)	4.00				
I-J	0.35	-91.8 -91.8 0.07 (1)	10.00				
Q-B	-2830 0	0.0 0.0 0.16 (1)	8.82				
K-I	-3687 0	0.0 0.0 0.21 (1)	6.12				
Q-P	0 0	-18.5 -18.5 0.05 (4)	10.00				
P-O	0 2906	-18.5 -18.5 0.22 (1)	10.00				
O-N	0 5820	-18.5 -18.5 0.41 (1)	10.00				
N-M	0 5820	-18.5 -18.5 0.41 (1)	10.00				
M-U	0 3931	-18.5 -18.5 0.33 (1)	10.00				
U-V	0 3931	-18.5 -18.5 0.33 (1)	10.00				
V-W	0 3931	-18.5 -18.5 0.33 (1)	10.00				
W-L	0 3931	-18.5 -18.5 0.33 (1)	10.00				
L-X	0 0	-18.5 -18.5 0.09 (4)	10.00				
X-Y	0 0	-18.5 -18.5 0.09 (4)	10.00				
Y-K	0 0	-18.5 -18.5 0.09 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)					
JT	LOC.	LC1	MAX.	MAX+	
H	22-8-8	-512	-512		FACE FRONT VERT TOTAL
L	22-8-12	-36	-36		FACE FRONT VERT TOTAL
M	16-5-8	-1959	-1959		FACE FRONT VERT TOTAL
R	17-8-12	-178	-178		FACE FRONT VERT TOTAL
S	18-8-12	-178	-178		FACE FRONT VERT TOTAL
T	20-8-12	-178	-178		FACE FRONT VERT TOTAL
U	17-8-12	-36	-36		FACE FRONT VERT TOTAL
V	18-8-12	-36	-36		FACE FRONT VERT TOTAL
W	20-8-12	-36	-36		FACE FRONT VERT TOTAL
X	24-8-12	-36	-36		FACE FRONT VERT TOTAL
Y	28-8-12	-36	-36		FACE FRONT VERT TOTAL

TOTAL WEIGHT = 2 X 137 = 274 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(58% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.96")
CALCULATED VERT. DEFL. (LL) = L/899 (0.12")
ALLOWABLE DEFL. (TL) = L/360 (0.96")
CALCULATED VERT. DEFL. (TL) = L/899 (0.22")

CSI: TC=0.81-1.00 (G-H:1), BC=0.41-1.00 (M-O:1), WB=0.48-1.00 (I-L:1), SS=0.31-1.00 (Q-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1687	788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (P) (INPUT = 0.90)
JSI METAL= 0.53 (N) (INPUT = 1.00)



Structural component only
DWG# T-2006881 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLV	JOB DESC.	DRWG NO.
408016	T7	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Fri Apr 24 13:21:04 2020 Page 2
ID:DMCubINVR6TstFoe31v6I zns1I-qiUN 5EvvD4hRL2PUS1PcYsameGIVD4Lc0VvaQzNVrz

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.75	2.75
C	TTWW-m	MT20	5.0	8.0	1.75	3.00
D	TMW+w	MT20	2.0	4.0		
E	TMWW-t	MT20	4.0	4.0		
F	TS-t	MT20	3.0	8.0		
G	TMW+w	MT20	2.0	4.0		
H	TTWW-m	MT20	5.0	8.0	1.75	3.00
I	TMVW-p	MT20	5.0	6.0	1.75	2.75
K	BMV1+p	MT20	3.0	6.0		
L	BMWW-t	MT20	6.0	6.0		
M	BMWWW-t	MT20	5.0	8.0		
N	BS-t	MT20	5.0	6.0		
O	BMWWW-t	MT20	5.0	8.0		
P	BMWW-t	MT20	5.0	6.0		
Q	BMV1+p	MT20	3.0	6.0		

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2006881 *WZ*

JOB NAME 408016	TRUSS NAME T8	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MtTek Industries, Inc. Fri Apr 24 13:21:06 2020 Page 1
ID:DMCubINVR6TstFoe31v6I zns11-n608PnG9RrLPgiCnci3ihzx0sSyRz0Qe4K OfJzNVrx

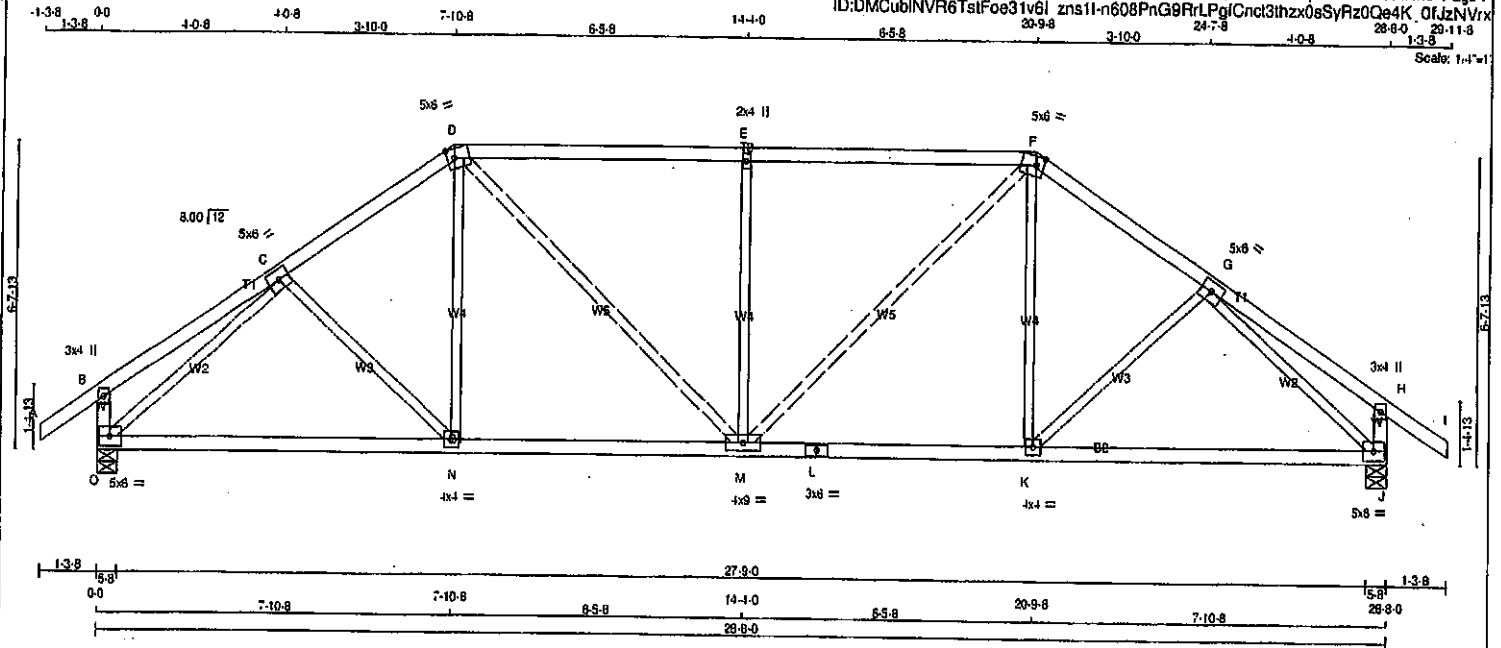

TOTAL WEIGHT = 121 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
D - F	2x4	DRY	No.2	SPF		
F - I	2x4	DRY	No.2	SPF		
O - B	2x4	DRY	No.2	SPF		
J - H	2x4	DRY	No.2	SPF		
O - L	2x4	DRY	No.2	SPF		
L - J	2x4	DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
O	1708	0	1708	0
J	1708	0	1708	0

UNFACTORED REACTIONS	1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW
O	1204	804
J	1204	804

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.28 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	MAX. FACTORED	MEMB.	FORCE	MAX. FACTORED
FR-TO	(LBS)	(PLF)	CSI (LC)	FR-TO	(LBS)	CSI (LC)
A-B	0.35	-91.8	-91.8 0.12 (1)	C-N	-36	42
B-C	0.22	-91.8	-91.8 0.21 (1)	N-D	0	183
C-D	-1753	-91.8	-91.8 0.20 (1)	D-M	0	585
D-E	-1858	-91.8	-91.8 0.55 (1)	M-E	-728	0
E-F	-1858	-91.8	-91.8 0.55 (1)	M-F	0	585
F-G	-1753	-91.8	-91.8 0.20 (1)	K-F	0	183
G-H	0.22	-91.8	-91.8 0.21 (1)	K-G	-36	42
H-I	0.35	-91.8	-91.8 0.12 (1)	O-C	-2012	0
O-B	-287	0.0	0.0 0.03 (1)	G-J	-2012	0
J-H	-287	0.0	0.0 0.03 (1)			
O-N	0	1465	-18.5 -18.5 0.38 (1)			
N-M	0	1441	-18.5 -18.5 0.39 (4)			
M-L	0	1441	-18.5 -18.5 0.39 (4)			
L-K	0	1441	-18.5 -18.5 0.39 (4)			
K-J	0	1465	-18.5 -18.5 0.38 (1)			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.96")
CALCULATED VERT. DEFL. (LL) = L/999 (0.07")
ALLOWABLE DEFL. (TL) = L/360 (0.96")
CALCULATED VERT. DEFL. (TL) = L/999 (0.16")

CSI: TC=0.55/1.00 (D-E:1), BC=0.39/1.00 (M-N:4),
WB=0.85/1.00 (C-O:1), SSI=0.29/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP (DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	618	354	1887


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.82 (J) (INPUT = 0.80)
JSI METAL = 0.49 (G) (INPUT = 1.00)

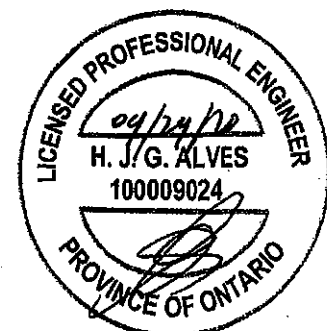

Structural component only
DWG# T-2006882

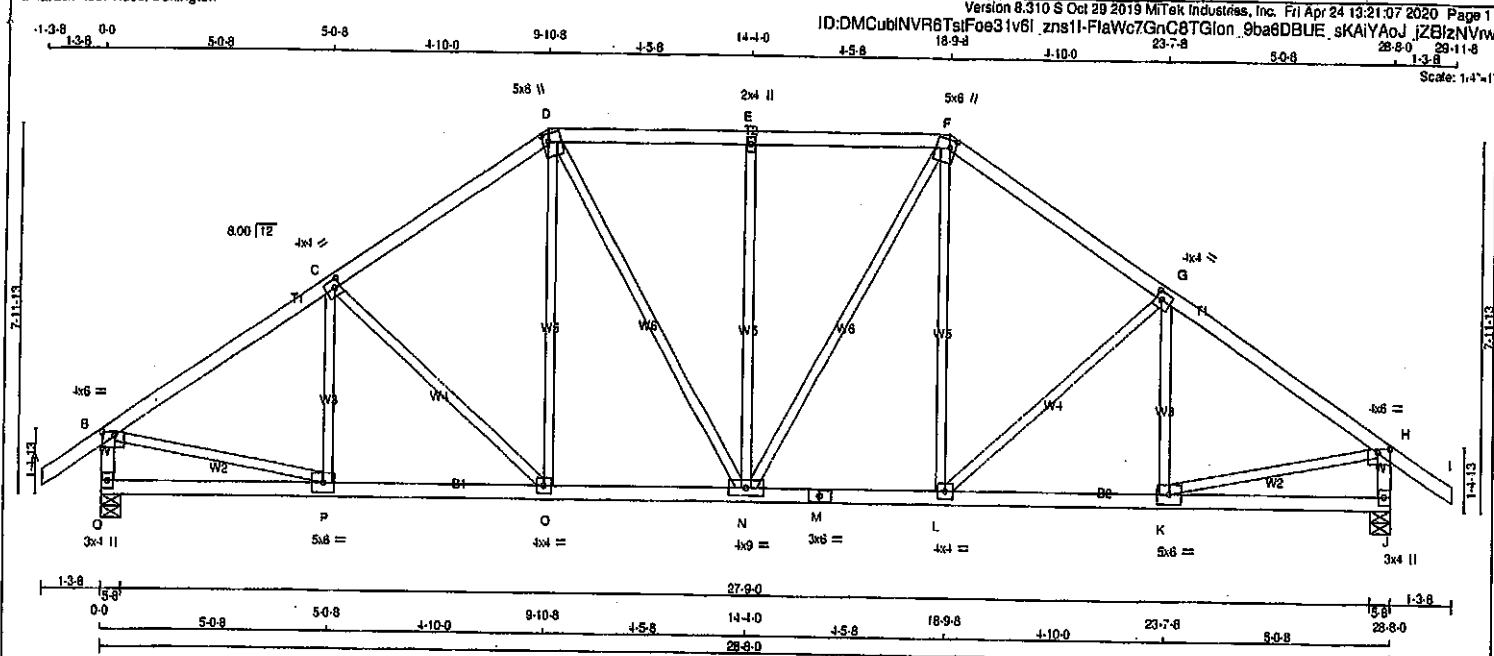

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
Q - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
Q - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	8.0	1.00	3.25
C	TMWW-t	MT20	4.0	4.0	2.00	1.50
D	TTWW-m	MT20	5.0	6.0	2.00	1.50
E	TMW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.00	1.50
G	TMWW-t	MT20	4.0	4.0	2.00	1.50
H	TMVW-p	MT20	4.0	6.0	1.00	3.25
J	BMV1-p	MT20	3.0	4.0		
K	BMWW-t	MT20	5.0	6.0		
L	BMWW-t	MT20	4.0	4.0		
M	BS-t	MT20	3.0	6.0		
N	BMWW-t	MT20	4.0	9.0		
O	BMWW-t	MT20	4.0	4.0		
P	BMWW-t	MT20	5.0	6.0		
Q	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
Q	1706	0	1706	0	5-8	5-8
J	1706	0	1706	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LGASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
Q	1204	804.0	0	0	0	0	0
J	1204	804.0	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.63 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS			WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	FORCE (LBS)	MAX CSI (LC)
A-B	0 35	-91.8	-91.8	10.00	P-C	-232 4	0.08 (1)
B-C	-1828 0	-91.8	-91.8	10.00	C-O	-285 0	0.23 (1)
C-D	-1835 0	-91.8	-91.8	10.00	O-D	0 279	0.06 (1)
D-E	-1503 0	-91.8	-91.8	10.00	D-N	0 330	0.07 (1)
E-F	-1503 0	-91.8	-91.8	10.00	N-E	-495 0	0.80 (1)
F-G	-1635 0	-91.8	-91.8	10.00	N-F	0 330	0.07 (1)
G-H	-1620 0	-91.8	-91.8	10.00	L-F	0 279	0.06 (1)
H-I	0 35	-91.8	-91.8	10.00	L-G	-285 0	0.23 (1)
I-J	-1668 0	0.0	0.0	10.00	K-G	-232 4	0.08 (1)
J-H	-1666 0	0.0	0.0	10.00	B-P	0 1580	0.38 (1)
					K-H	0 1580	0.38 (1)
Q-P	0 0	-18.5	-18.5	10.00			
P-O	0 1545	-18.5	-18.5	10.00			
O-N	0 1337	-18.5	-18.5	10.00			
N-M	0 1337	-18.5	-18.5	10.00			
M-L	0 1337	-18.5	-18.5	10.00			
L-K	0 1545	-18.5	-18.5	10.00			
K-J	0 0	-18.5	-18.5	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.98")
CALCULATED VERT. DEFL. (LL) = L/999 (0.06")
ALLOWABLE DEFL. (TL) = L/360 (0.98")
CALCULATED VERT. DEFL. (TL) = L/999 (0.11")

CSI: TC=0.34/1.00 (B-C:1), BC=0.29/1.00 (O-P:1), WB=0.60/1.00 (E-N:1), SS=0.20/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP (RY) SHEAR SECTION (PSI) (PL) (FL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (F) (INPUT = 0.90)
JSI METAL = 0.42 (H) (INPUT = 1.00)



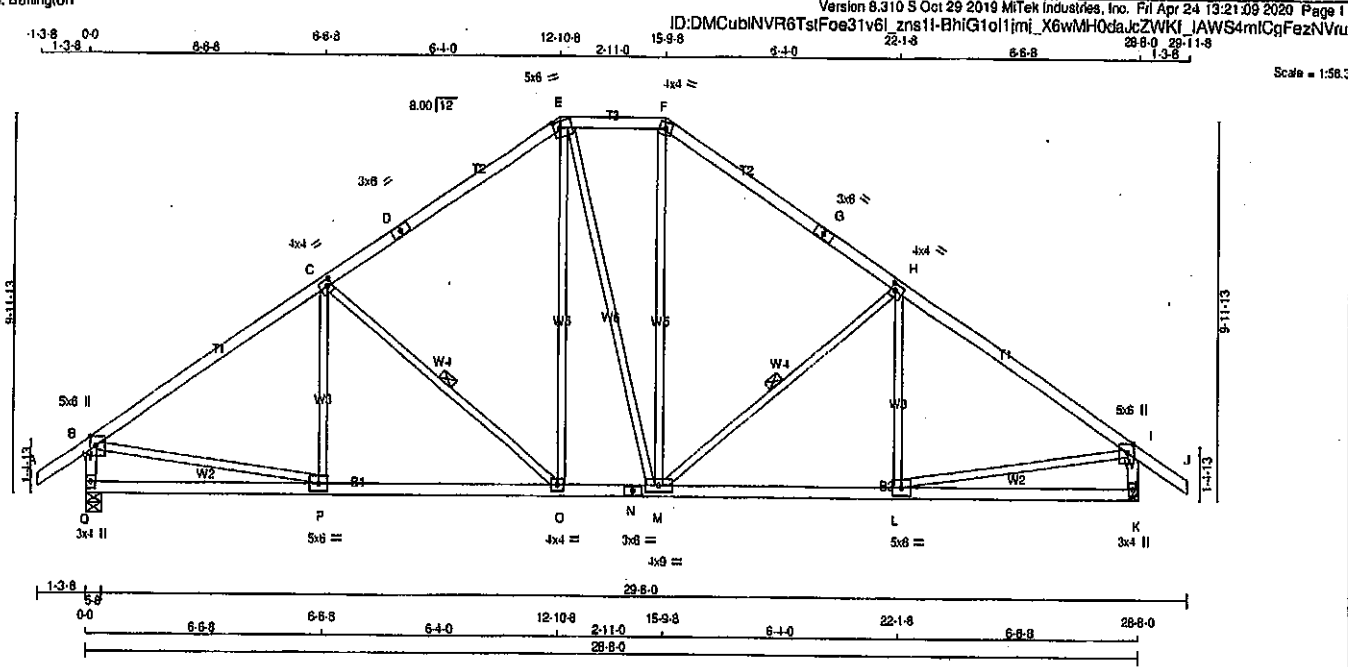

CHORDS	SIZE	DRY	NO.2	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
G - J	2x4	DRY	No.2	SPF
Q - B	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
Q - N	2x4	DRY	No.2	SPF
N - K	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	5.0	6.0	2.75	2.00
C TMWW-l	MT20	4.0	4.0	2.00	1.50
D TS-l	MT20	3.0	6.0		
E TTWW-m	MT20	5.0	6.0	2.00	2.00
F TTW-m	MT20	4.0	4.0		
G TS-l	MT20	3.0	6.0		
H TMWW-l	MT20	4.0	4.0	2.00	1.50
I TMVW+p	MT20	5.0	6.0	2.75	2.00
K BMV1+p	MT20	3.0	4.0		
L BMWW-l	MT20	5.0	6.0		
M BMWWW-l	MT20	4.0	9.0		
N BS-l	MT20	3.0	6.0		
O BMWW-l	MT20	4.0	4.0		
P BMWW-l	MT20	5.0	6.0		
Q BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX		
Q	1708	0	1708	0	5-8	5-8		
K	1708	0	1708	0	MECHANICAL			

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT K. MINIMUM BEARING LENGTH AT JOINT K = 3-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
Q	1204	804	0	0	0	0	0	0
K	1204	804	0	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.27 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O, H-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS			FACTORED			WEBS		
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. LOAD (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM	TO		FR-TO			
A-B	0 35	-91.8	-91.8	0.12 (1)	10.00	P-C	-120 70 0.08 (1)	
B-C	-1842 0	-91.8	-91.8	0.60 (1)	4.27	C-O	-535 0 0.28 (1)	
C-D	-1433 0	-91.8	-91.8	0.55 (1)	4.77	O-E	0 418 0.09 (1)	
D-E	-1433 0	-91.8	-91.8	0.55 (1)	4.77	E-M	0 5 0.00 (1)	
E-F	-1169 0	-91.8	-91.8	0.11 (1)	5.79	M-F	0 424 0.10 (1)	
F-G	-1434 0	-91.8	-91.8	0.55 (1)	4.77	M-H	-532 0 0.28 (1)	
G-H	-1434 0	-91.8	-91.8	0.55 (1)	4.77	L-H	-123 68 0.08 (1)	
H-I	-1841 0	-91.8	-91.8	0.60 (1)	4.27	B-P	0 1587 0.36 (1)	
I-J	0 35	-91.8	-91.8	0.12 (1)	10.00	L-I	0 1586 0.36 (1)	
Q-B	-1857 0	0.0	0.0	0.17 (1)	6.44			
K-I	-1857 0	0.0	0.0	0.17 (1)	6.44			
Q-P	0 0	-18.5	-18.5	0.20 (4)	10.00			
P-O	0 1565	-18.5	-18.5	0.35 (1)	10.00			
O-N	0 1182	-18.5	-18.5	0.25 (1)	10.00			
N-M	0 1182	-18.5	-18.5	0.25 (1)	10.00			
M-L	0 1565	-18.5	-18.5	0.35 (1)	10.00			
L-K	0 0	-18.5	-18.5	0.19 (4)	10.00			

TOTAL WEIGHT = 132 lb (MIF)

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF
SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.96")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
 ALLOWABLE DEFL.(TL) = L/360 (0.96")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.80/1.00 (B-C:1), BC=0.35/1.00 (O-P:1), WB=0.36/1.00 (B-P:1), SSI=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1657 788 1987 1856

PLATE PLACEMENT TOL = 0.250 Inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (B) (INPUT = 0.90)
 JSI METAL = 0.78 (B) (INPUT = 1.00)




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408016	T13	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 24 13:21:11 2020 Page 1

ID:DMCubINVR6TsiF0e31v6l_zns11-74p1SUKIFNznQ4IOQ1201eo_TbQePnNDchnKWzNVrs

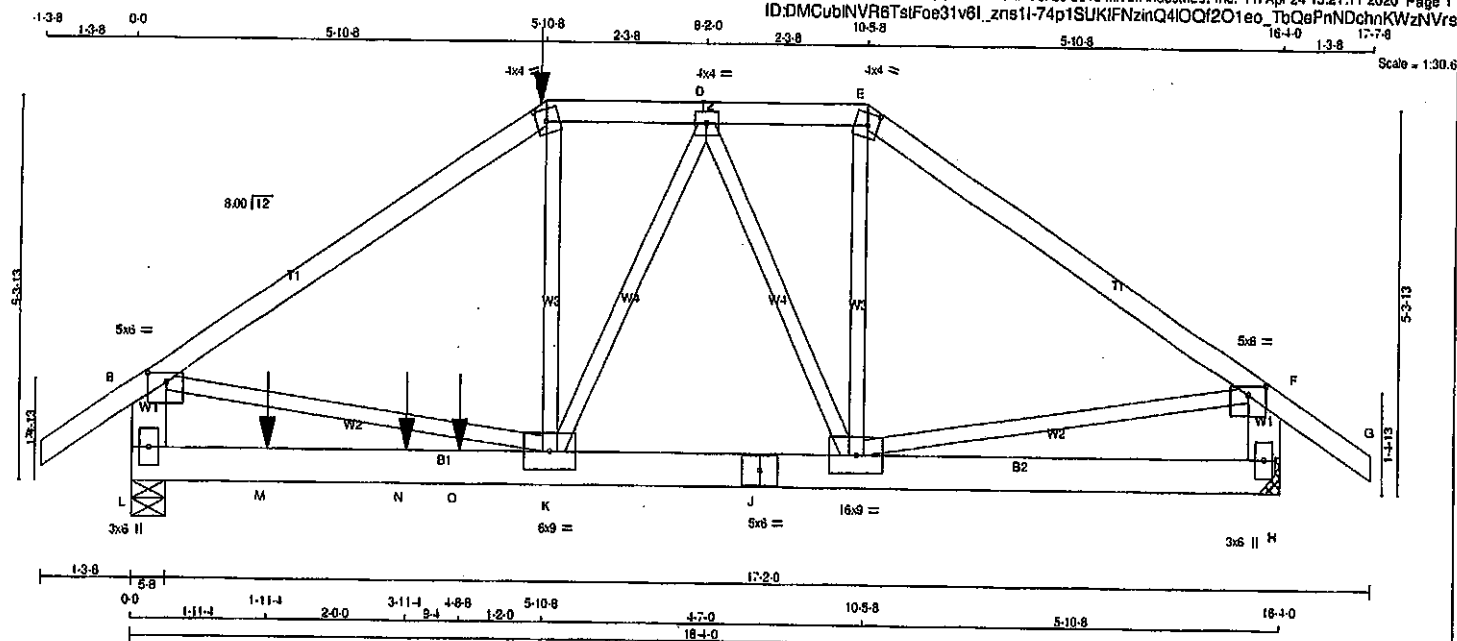

TOTAL WEIGHT = 82 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
L - B	2x6	DRY	No.2
H - F	2x6	DRY	No.2
L - J	2x6	DRY	No.2
J - H	2x6	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	1.50	3.00
C	TTW-m	MT20	4.0	4.0	2.00	1.75
D	TMVW-t	MT20	4.0	4.0		
E	TTW-m	MT20	4.0	4.0	2.00	1.75
F	TMVW-p	MT20	5.0	8.0	1.50	3.00
H	BMV1+p	MT20	3.0	6.0		
I	BMVWW-1	MT20	6.0	9.0		
J	BS-1	MT20	5.0	6.0		
K	BMVWW-1	MT20	6.0	9.0		
L	BMV1+p	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	DOWN	IN-SX	IN-SX
L	2062	0	0	5-8
H	1468	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	1453	982	0	0	0	471	0
H	1033	707	0	0	0	326	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.65 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 35	-91.8 -91.8 0.14 (1)	10.00	K-C	0 459	0.11 (1)	
B-C	-2077 0	-91.8 -91.8 0.85 (1)	3.65	L-E	0 438	0.11 (1)	
C-D	-1741 0	-91.8 -91.8 0.10 (1)	4.94	B-K	0 1749	0.43 (1)	
D-E	-1215 0	-91.8 -91.8 0.08 (1)	5.71	L-F	0 1217	0.30 (1)	
E-F	-1444 0	-91.8 -91.8 0.74 (1)	4.37	K-D	0 542	0.13 (1)	
F-G	0 35	-91.8 -91.8 0.14 (1)	10.00	D-I	-787 0	0.38 (1)	
L-B	-1835 0	0.0 0.0 0.13 (1)	7.34				
H-F	-1397 0	0.0 0.0 0.10 (1)	7.81				
L-M	0 0	-18.5 -18.5 0.54 (1)	10.00				
M-N	0 0	-18.5 -18.5 0.54 (1)	10.00				
N-O	0 0	-18.5 -18.5 0.54 (1)	10.00				
O-K	0 0	-18.5 -18.5 0.54 (1)	10.00				
K-J	0 1526	-18.5 -18.5 0.66 (1)	10.00				
J-I	0 1526	-18.5 -18.5 0.66 (1)	10.00				
I-H	0 0	-18.5 -18.5 0.10 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

LOC.	LOC.	LOC.	LOC.	LOC.	LOC.	LOC.	LOC.
C	5-10-8	-327	-327	---	FRONT	VERT	TOTAL
M	1-11-4	-36	-36	---	FRONT	VERT	TOTAL
N	3-11-4	-36	-36	---	FRONT	VERT	TOTAL
O	4-8-8	-1078	-1078	---	FRONT	VERT	TOTAL

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CSI: TC=0.85/1.00 (B-C:1), BC=0.66/1.00 (L-K:1),
WB=0.43/1.00 (B-K:1), SS=0.69/1.00 (K-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)
MT20	618	354

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.83 (J) (INPUT = 0.90)
JSI METAL= 0.81 (J) (INPUT = 1.00)

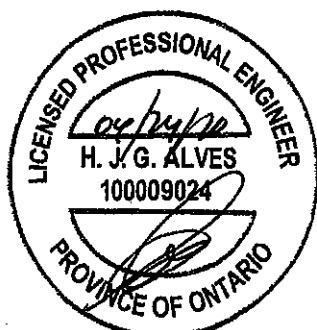


Structural component only
DWG# T-2006887

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408016	T15	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Fri Apr 24 13:21:12 2020 Page 1
ID:DMCubINVR6TstFoe31v6l zns11-bGNPlqKw0h5ZCafky8AHwEB7A13yNqXXSGRKszzNVrr

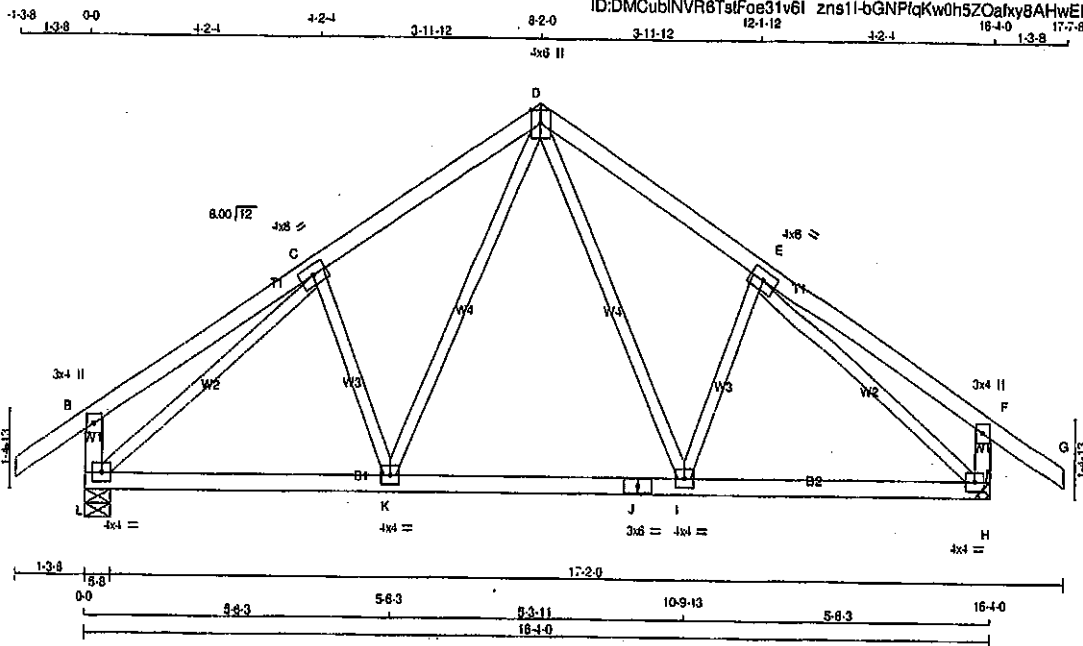

Scale = 1:38.9

LUMBER				
N. L. G. A. RULES				
CHORDS		SIZE	LUMBER	DESCR
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
L - B	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (tables in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0			
C	TMVW-i	MT20	4.0	8.0			
D	ITVW+p	MT20	4.0	8.0	Edge		
E	TMVW-i	MT20	4.0	8.0			
F	TMV+p	MT20	3.0	4.0			
H	BMVW-i	MT20	4.0	4.0			
I	BMVW-i	MT20	4.0	4.0			
J	BS-i	MT20	3.0	8.0			
K	BMVW-i	MT20	4.0	4.0			
L	BMVW-i	MT20	4.0	4.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	UP/LIFT	KN-SX
L	1026	0	0	5-8
H	1026	0	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	723	-488	0	0	0	235	0
H	723	-488	0	0	0	235	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0.35	-91.8	-91.8 0.12 (1)	10.00	D-I	0.338	0.08 (1)
B-C	0.24	-91.8	-91.8 0.24 (1)	10.00	I-E	-219	0.06 (1)
C-D	-851	0	-91.8 -91.8 0.19 (1)	6.25	K-D	0.338	0.08 (1)
D-E	-851	0	-91.8 -91.8 0.19 (1)	6.25	C-K	-219	0.08 (1)
E-F	0.24	-91.8	-91.8 0.24 (1)	10.00	L-C	-1048	0.53 (1)
F-G	0.35	-91.8	-91.8 0.12 (1)	10.00	E-H	-1048	0.53 (1)
L-B	-289	0	0.0 0.0 0.03 (1)	7.81			
H-F	-289	0	0.0 0.0 0.03 (1)	7.81			
L-K	0.767	-18.5	-18.5 0.19 (1)	10.00			
K-J	0.561	-18.5	-18.5 0.17 (4)	10.00			
J-I	0.561	-18.5	-18.5 0.17 (4)	10.00			
I-H	0.767	-18.5	-18.5 0.19 (1)	10.00			

TOTAL WEIGHT = 73 lb (MJF)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 N.C.C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.54")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CS1: TC=0.24/1.00 (B-C:1), BC=0.19/1.00 (K-L:1), WB=0.53/1.00 (C-L:1), SS=0.15/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1658


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (L) (INPUT = 0.90)
JSI METAL= 0.29 (L) (INPUT = 1.00)



Structural component only
DWG# T-2006888

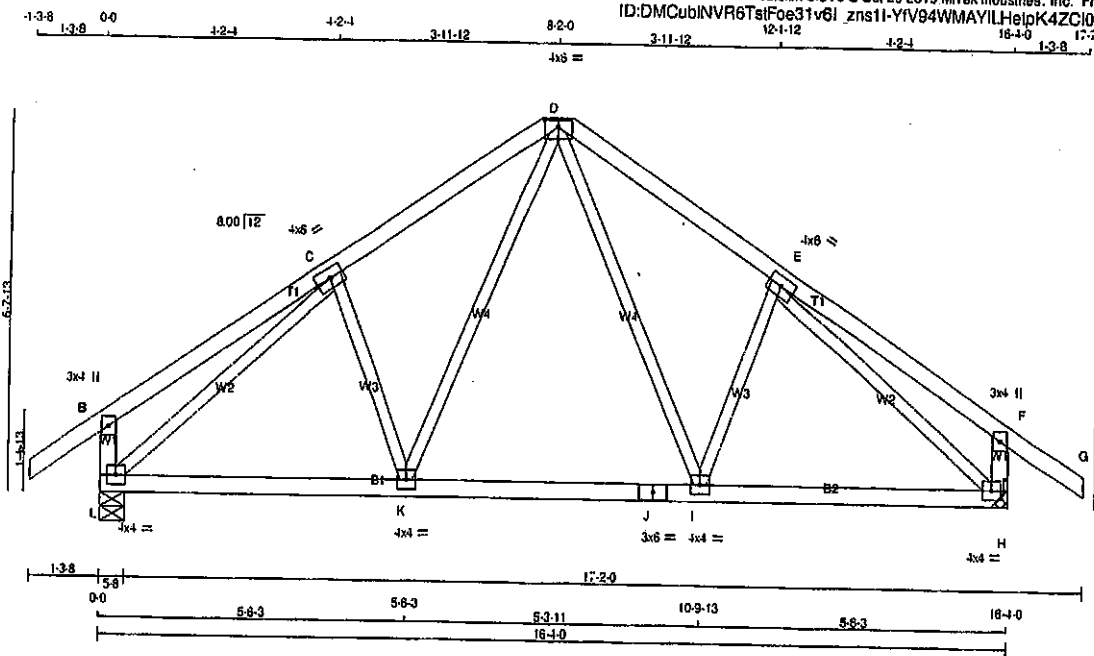

Scale = 1:38.7

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
L - B	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-1	MT20	4.0	6.0		
D	TMTMWm	MT20	4.0	6.0	1.50	3.00
E	TMVW-1	MT20	4.0	6.0		
F	TMV+p	MT20	3.0	4.0		
H	BMVW-1	MT20	4.0	4.0		
I	BMVW-1	MT20	4.0	4.0		
J	BS-1	MT20	3.0	6.0		
K	BMVW-1	MT20	4.0	4.0		
L	BMVW-1	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT VERT	DOWN	IN-SX	IN-SX
L 1026 0	1026 0	5-8	5-8
H 1026 0	1026 0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	723	488.0	0.0	0.0	0.0	235.0	0.0
H	723	488.0	0.0	0.0	0.0	235.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0.35	-91.8 -91.8	0.12 (1)	D-I	0.338	0.08 (1)	
B-C	0.24	-91.8 -91.8	0.24 (1)	I-E	-219.0	0.08 (1)	
C-D	-951.0	-91.8 -91.8	0.19 (1)	K-D	0.338	0.08 (1)	
D-E	-951.0	-91.8 -91.8	0.18 (1)	C-K	-219.0	0.08 (1)	
E-F	0.24	-91.8 -91.8	0.24 (1)	L-C	-1048.0	0.53 (1)	
F-G	0.35	-91.8 -91.8	0.12 (1)	E-H	-1048.0	0.53 (1)	
L-B	-269.0	0.0 0.0	0.03 (1)				
H-F	-269.0	0.0 0.0	0.03 (1)				
L-K	0.767	-18.5 -18.5	0.19 (1)				
K-J	0.561	-18.5 -18.5	0.17 (4)				
J-I	0.561	-18.5 -18.5	0.17 (4)				
I-H	0.767	-18.5 -18.5	0.19 (1)				

TOTAL WEIGHT = 73 lb

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.8 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.54")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
 ALLOWABLE DEFL.(TL) = L/360 (0.54")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.24/1.00 (B-C:1), BC=0.19/1.00 (K-L:1), WB=0.53/1.00 (C-L:1), SS=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PLI)		(PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	618	354	1887	788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (L) (INPUT = 0.90)
 JSI METAL = 0.29 (L) (INPUT = 1.00)



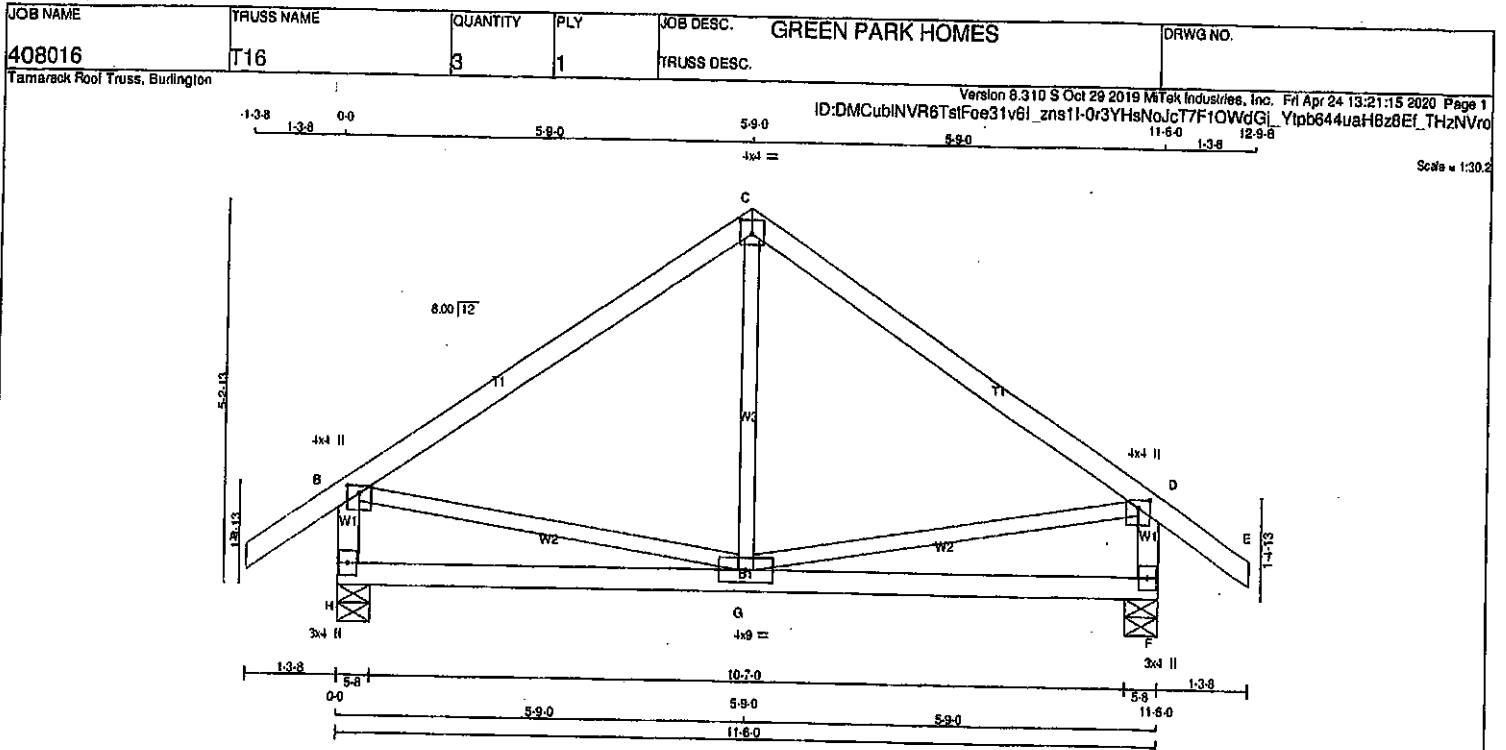

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	QESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
H - B	2x4	DRY No.2	SPF
F - D	2x4	DRY No.2	SPF
H - F	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TMVW+p	MT20	4.0	4.0	1.25	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-I	MT20	4.0	9.0		
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECRD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
H	760	0	760	0	5-8	5-8
F	760	0	760	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE COMBINED		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM. LIVE	PERM. LIVE			
H	535	364.0	0.0	0.0	0.0	171.0	0.0
F	535	364.0	0.0	0.0	0.0	171.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 MAX (PLF) CSI (LC)			MAX. UNBRACED LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS) CSI (LC)		
		FROM	TO				FROM	TO	
A-B	0.35	-91.8	-91.8	0.12 (1)	10.00	G-C	-14.94	0.03 (4)	
B-C	-483.0	-91.8	-91.8	0.39 (1)	6.25	B-G	0.392	0.09 (1)	
C-D	-483.0	-91.8	-91.8	0.39 (1)	6.25	G-D	0.392	0.09 (1)	
D-E	0.35	-91.8	-91.8	0.12 (1)	10.00				
H-B	-719.0	0.0	0.0	0.07 (1)	7.81				
F-D	-719.0	0.0	0.0	0.07 (1)	7.81				
H-G	0.0	-18.5	-18.5	0.17 (4)	10.00				
G-F	0.0	-18.5	-18.5	0.17 (4)	10.00				

TOTAL WEIGHT = 3 X 48 = 143 lb [M/F]

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.38")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.38")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.39/1.00 (B-C:1), BC=0.17/1.00 (G-H:4), WB=0.09/1.00 (B-G:1), SSI=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MT20	618	354	1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.55 (B) (INPUT = 0.90)
JSI METAL= 0.16 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006890

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408016	T16S	3	1	GREEN PARK HOMES		

Tamarack Robt Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 13:21:16 2020 Page 1
ID:DMCubINVR6Tsf0e31v6I zns11-U1dwVCNQ4yb IBzIB FD54LpMUPGJO6NuPY?kzNVm

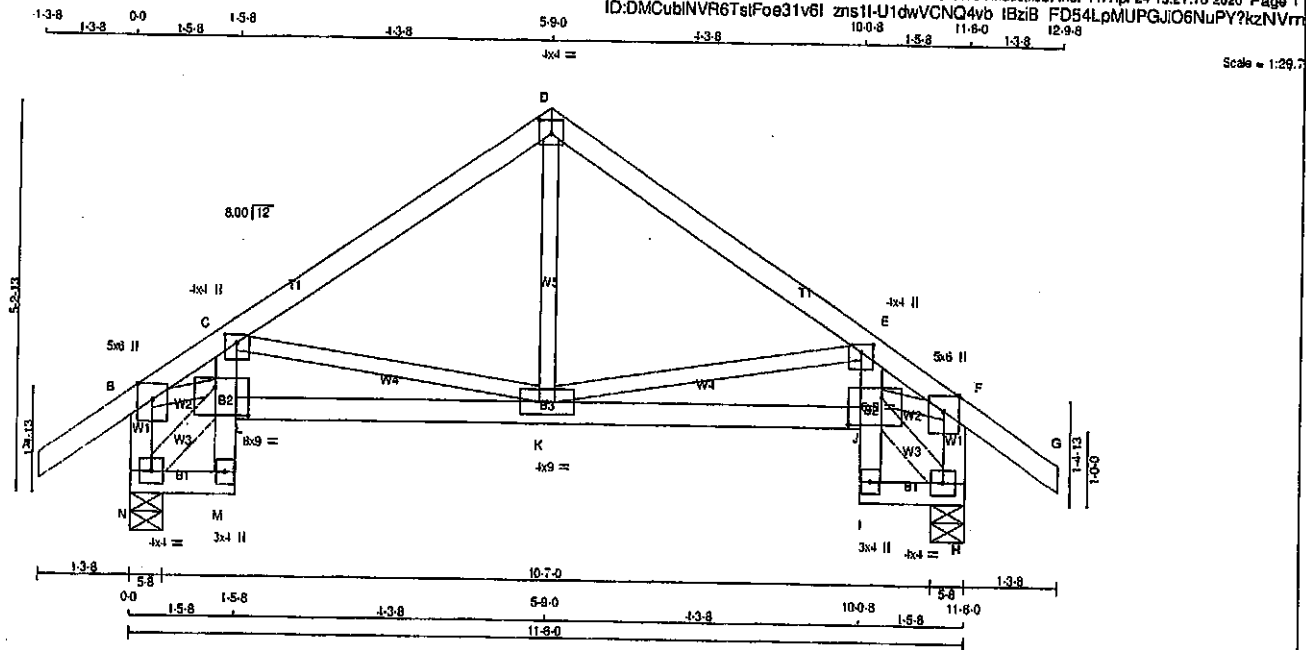

Scale = 1:29.7

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
N - B	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
N - M	2x4	DRY	No.2	SPF	
M - C	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
I - E	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	
N - L	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	Edge	
C	TMVW+p	MT20	4.0	4.0	1.25	2.00
D	TTW+p	MT20	4.0	4.0	2.25	2.00
E	TMVW+p	MT20	4.0	4.0	1.25	2.00
F	TMVW+p	MT20	5.0	6.0	Edge	
H	BMVW1-i	MT20	4.0	4.0		
I	BMV+p	MT20	3.0	4.0		
J	BVMWV1-i	MT20	6.0	9.0	4.50	5.50
K	BVMWV1-i	MT20	4.0	9.0		
L	BVMWV1-i	MT20	6.0	9.0	4.50	5.50
M	BMV+p	MT20	3.0	4.0		
N	BMVW1-i	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
N	760	0	760	0
H	760	0	760	0

UNFACTORED REACTIONS

	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
N	535	364	0	0	0	171	0
H	535	364	0	0	0	171	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.81 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 35	-91.8 -91.8 0.12 (1)	10.00	K-D	0 252	0.08 (1)	
B-C	-1137 0	-91.8 -91.8 0.14 (1)	5.81	K-E	-601 0	0.21 (1)	
C-D	-592 0	-91.8 -91.8 0.23 (1)	6.25	C-K	-601 0	0.21 (1)	
D-E	-562 0	-91.8 -91.8 0.23 (1)	6.25	N-L	-71 0	0.01 (1)	
E-F	-1137 0	-91.8 -91.8 0.14 (1)	5.81	B-L	0 982	0.22 (1)	
F-G	0 35	-91.8 -91.8 0.12 (1)	10.00	J-H	-71 0	0.01 (1)	
N-B	-699 0	0.0 0.0 0.07 (1)	7.81	J-F	0 962	0.22 (1)	
H-F	-699 0	0.0 0.0 0.07 (1)	7.81				
N-M	0 52	-18.5 -18.5 0.01 (1)	10.00				
M-L	0 14	0.0 0.0 0.09 (1)	10.00				
L-C	0 148	0.0 0.0 0.11 (1)	10.00				
L-K	0 1044	-18.5 -18.5 0.23 (1)	10.00				
K-J	0 1044	-18.5 -18.5 0.23 (1)	10.00				
I-J	0 14	0.0 0.0 0.09 (1)	10.00				
J-E	0 148	0.0 0.0 0.11 (1)	10.00				
I-H	0 52	-18.5 -18.5 0.01 (1)	10.00				

TOTAL WEIGHT = 3 X 54 = 161 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.38")
CALCULATED VERT. DEFL. (LL) = L/989 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.38")
CALCULATED VERT. DEFL. (TL) = L/989 (0.04")

CSI: TC=0.23/1.00 (C-D:1), BC=0.23/1.00 (K-L:1), WB=0.22/1.00 (B-L:1), SSI=0.15/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PS)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.88 (F) (INPUT = 0.90)

JSI METAL=0.46 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006891

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRAWG NO.
408016	T17	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Fri Apr 24 13:21:17 2020 Page 2
ID=DMCubINVR6TsIFoe31v6I_zns1I-yDBIjXO3rDirVLyVlhmSdlussug_22cGcY85YAzNVm

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
E	TMWW-I	MT20	5.0	6.0		
F	TMWW-I	MT20	6.0	16.0	2.75	5.25
H	BMW+W	MT20	2.0	4.0		
I	BMWW-I	MT20	5.0	6.0	2.25	2.00
J	BS-I	MT20	3.0	6.0		
K	BMWWW-I	MT20	4.0	9.0		
L	BMW+W	MT20	2.0	4.0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	OIR.	TYPE	HEEL	CONN.
S	11-11-8	-116	-116	---	BACK	VERT	TOTAL	---	C1
T	13-11-8	-116	-116	---	BACK	VERT	TOTAL	---	C1
U	15-11-8	-116	-116	---	BACK	VERT	TOTAL	---	C1
V	2-0-12	-61	-61	---	BACK	VERT	TOTAL	---	C1
W	5-11-6	-61	-61	---	BACK	VERT	TOTAL	---	C1
X	7-11-8	-61	-61	---	BACK	VERT	TOTAL	---	C1
Y	9-11-6	-61	-61	---	BACK	VERT	TOTAL	---	C1
Z	13-11-8	-61	-61	---	BACK	VERT	TOTAL	---	C1
AA	15-11-8	-61	-61	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.



JSI GRIP = 0.88 (I) (INPUT = 0.90)
JSI METAL = 0.83 (J) (INPUT = 1.00)



Structural component only.
DWG# T-2006892 *72*

JOB NAME	TRUSS NAME	QUANTITY	PLV	JOB DESC.	TRUSS DESC.	DRWG NO.
408038	T20	1	2	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

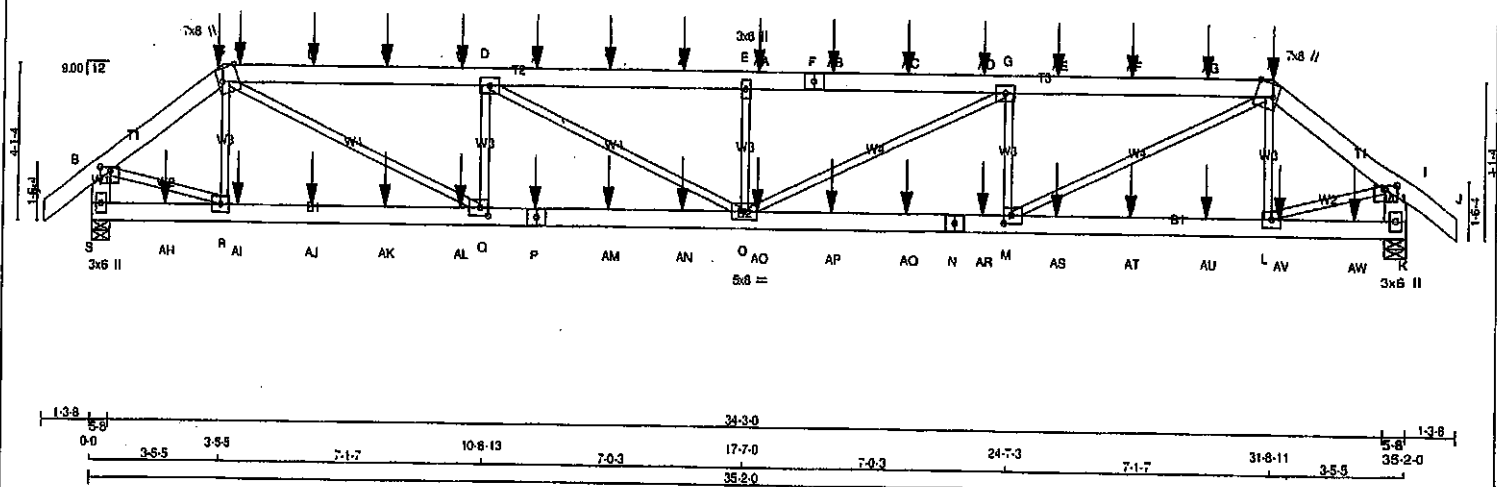

LUMBER N. L. G. A. RULES CHORDS SIZE A - C 2x6 DRY No.2 C - F 2x6 DRY No.2 F - H 2x6 DRY No.2 H - J 2x6 DRY No.2 S - B 2x6 DRY No.2 K - I 2x6 DRY No.2 S - P 2x6 DRY No.2 P - N 2x6 DRY No.2 N - K 2x6 DRY No.2 ALL WEBS 2x3 DRY No.2 EXCEPT ORY: SEASONED LUMBER. DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS: CHORDS #ROWS SURFACE SPACING (IN) LOAD(PLF) TOP CHORDS : (0.122"x3") SPIRAL NAILS A-C 2 12 SIDE(122.0) C-F 2 12 SIDE(61.0) F-H 2 12 SIDE(61.0) H-J 2 12 SIDE(122.0) S-B 2 12 TOP K-I 2 12 TOP BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS S-P 2 12 SIDE(0.0) P-N 2 12 SIDE(0.0) N-K 2 12 SIDE(183.1) WEBS : (0.122"x3") SPIRAL NAILS 2x3 1 6 NAILS TO BE DRIVEN FROM ONE SIDE ONLY. GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS. TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED MAXIMUM FACTORED INPUT REQD GROSS REACTION GROSS REACTION BRG BRG JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX S 3389 0 3389 0 0 5-8 5-8 K 3417 0 3417 0 0 5-8 5-8 UNFACTORED REACTIONS 1ST LOASE MAX. MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL S 2394 1585 0 0 0 0 0 809 0 0 0 K 2415 1593 0 0 0 0 0 821 0 0 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.89 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS MAX. FACTORED WEBS MEMB. FORCE FACTORED VERT. LOAD L01 MAX MAX. MEMB. FORCE MAX (LBS) (PLF) CSI (LC) UNBRAC LENGTH FR-TO (LBS) MAX FROM TO FR-TO A-B 0 39 -91.8 -91.8 0.04 (1) 10.00 R-C -601 0 0.07 (1) B-C -3743 0 -91.8 -91.8 0.07 (1) 5.77 C-Q 0 4266 0.53 (1) C-T -6768 0 -91.8 -91.8 0.38 (1) 4.29 Q-D -1739 0 0.21 (1) T-U -6768 0 -91.8 -91.8 0.38 (1) 4.29 D-O 0 1292 0.16 (1) U-V -6768 0 -91.8 -91.8 0.38 (1) 4.29 O-E -958 0 0.11 (1) V-W -6768 0 -91.8 -91.8 0.38 (1) 4.29 E-G 0 1286 0.16 (1) W-D -6768 0 -91.8 -91.8 0.38 (1) 4.29 M-G -1732 0 0.21 (1) D-X -7915 0 -91.8 -91.8 0.40 (1) 3.99 M-H 0 4250 0.53 (1) X-Y -7915 0 -91.8 -91.8 0.40 (1) 3.99 L-H -804 0 0.07 (1) Y-Z -7915 0 -91.8 -91.8 0.40 (1) 3.99 B-R 0 3099 0.38 (1) Z-E -7915 0 -91.8 -91.8 0.40 (1) 3.99 L-I 0 3119 0.39 (1) E-AA -7915 0 -91.8 -91.8 0.39 (1) 3.99 AA-F -7915 0 -91.8 -91.8 0.39 (1) 3.99 F-AB -7915 0 -91.8 -91.8 0.39 (1) 3.99 AB-AC -7915 0 -91.8 -91.8 0.39 (1) 3.99 AC-AD -7915 0 -91.8 -91.8 0.39 (1) 3.99 AD-G -7915 0 -91.8 -91.8 0.39 (1) 3.99 G-AE -6773 0 -91.8 -91.8 0.38 (1) 4.29 AE-AF -6773 0 -91.8 -91.8 0.38 (1) 4.29 AF-AG -6773 0 -91.8 -91.8 0.38 (1) 4.29 AG-H -6773 0 -91.8 -91.8 0.38 (1) 4.29 H-I -3787 0 -91.8 -91.8 0.07 (1) 5.76 I-J 0 39 -91.8 -91.8 0.04 (1) 10.00 S-B -3394 0 0.0 0.0 12 (1) 7.57 K-I -3414 0 0.0 0.0 12 (1) 7.55 S-AH 0 0 -18.5 -18.5 0.08 (4) 10.00 AH-R 0 0 -18.5 -18.5 0.08 (4) 10.00 R-AI 0 2985 -18.5 -18.5 0.28 (1) 10.00 AI-AJ 0 2965 -18.5 -18.5 0.28 (1) 10.00 AJ-AK 0 2965 -18.5 -18.5 0.28 (1) 10.00 AK-AL 0 2965 -18.5 -18.5 0.28 (1) 10.00 AL-Q 0 2965 -18.5 -18.5 0.28 (1) 10.00 Q-P 0 8789 -18.5 -18.5 0.51 (1) 10.00 P-AM 0 6769 -18.5 -18.5 0.51 (1) 10.00 AM-AN 0 8789 -18.5 -18.5 0.51 (1) 10.00 AN-O 0 8789 -18.5 -18.5 0.51 (1) 10.00 O-AO 0 6774 -18.5 -18.5 0.51 (1) 10.00 AO-AP 0 6774 -18.5 -18.5 0.51 (1) 10.00 AP-AQ 0 6774 -18.5 -18.5 0.51 (1) 10.00 AQ-N 0 6774 -18.5 -18.5 0.51 (1) 10.00 N-AR 0 6774 -18.5 -18.5 0.51 (1) 10.00 AR-M 0 6774 -18.5 -18.5 0.51 (1) 10.00										DESIGN CRITERIA *** SPECIAL LOADS ANALYSIS *** GEOMETRY AND/OR BASIC LOADS CHANGED BY USER. LOADS WERE DERIVED FROM USER INPUT NO FURTHER MODIFICATIONS WERE MADE SPECIFIED LOADS: TOP CH. LL = 25.8 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 39.0 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12 *** NON STANDARD GIRDER *** ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES. THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2018, CBC 2012, ABC 2019 - PART 9 OF CBC 2012 (2019 AMENDMENT) - CSA 088-09, CSA 088-14 - TPIC 2011, TPIC 2014 (55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL) = L/360 (1.17") CALCULATED VERT. DEFL.(LL) = L/999 (0.21") ALLOWABLE DEFL.(TL) = L/360 (1.17") CALCULATED VERT. DEFL.(TL) = L/999 (0.36") CSI: TC=0.40,1.00 (D-E:1), BC=0.51,1.00 (C-Q:1), WB=0.53,1.00 (C-Q:1), SSI=0.21,1.00 (C-D:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00 COMPANION LIVE LOAD FACTOR = 1.00 AUTOSOLVE HEELS OFF TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 818 354 1667 788 1987 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP = 0.88 (C) (INPUT = 0.90) JSI METAL = 0.83 (N) (INPUT = 1.00)	
---	--	--	--	--	--	--	--	--	--	--	--	--	--	---	--



Structural component only
DWG# T-2008897 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408038	T20	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 14:38:01 2020 Page 2
ID:DMCubINVR6TstFoe31v6f zns1f-9yNo p8 bonbrtVIScM6EBaen1DmKYxlrP7JzNUig

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	6.0	1.25 3.00
C	TTWW-m	MT20	7.0	8.0	Edge 5.50
D	TMVW-t	MT20	5.0	6.0	
E	TMVW-w	MT20	3.0	6.0	
F	TS-t	MT20	5.0	6.0	
G	TMVW-l	MT20	5.0	6.0	
H	TTWW-m	MT20	7.0	8.0	Edge 5.50
I	TMVW-p	MT20	5.0	6.0	1.25 3.00
K	BMV1-p	MT20	3.0	6.0	
L	BMVW-t	MT20	5.0	6.0	
M	BMVW-t	MT20	5.0	6.0	2.50 2.50
N	BS-t	MT20	5.0	6.0	
O	BMVW-w	MT20	5.0	6.0	
P	BS-t	MT20	5.0	6.0	
Q	BMVW-l	MT20	5.0	6.0	2.50 2.50
R	BMVW-l	MT20	5.0	6.0	
S	BMV1-p	MT20	3.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	LC1 (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO			FROM TO	LENGTH	FR-TO		
M-AS	0.2984	-18.5	-18.5	0.26 (1)	10.00		
AS-AT	0.2984	-18.5	-18.5	0.26 (1)	10.00		
AT-AU	0.2984	-18.5	-18.5	0.26 (1)	10.00		
AU-L	0.2984	-18.5	-18.5	0.26 (1)	10.00		
L-AW	0.0	-18.5	-18.5	0.08 (4)	10.00		
AW-AW	0.0	-18.5	-18.5	0.08 (4)	10.00		
AW-K	0.0	-18.5	-18.5	0.08 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	3-5-5	-44	-49	---	FRONT	VERT	DEAD	---	C1
C	3-5-5	-222	-222	---	FRONT	VERT	SNOW	---	C1
H	31-8-11	-44	-49	---	FRONT	VERT	DEAD	---	C1
H	31-8-11	-116	-116	---	BACK	VERT	TOTAL	---	C1
H	31-8-11	-222	-222	---	FRONT	VERT	SNOW	---	C1
P	11-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
T	3-11-4	-134	-134	---	BACK	VERT	TOTAL	---	C1
U	5-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	7-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	9-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
X	11-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
Y	13-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
Z	15-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AA	17-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AB	19-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AC	21-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AD	23-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AE	25-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AF	27-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AG	29-11-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AH	1-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AI	3-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AJ	5-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AK	7-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AL	9-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AM	13-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AN	15-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AO	17-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AP	19-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AQ	21-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AR	23-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AS	25-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AT	27-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AU	29-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AV	31-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AW	33-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2006897 72


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408038	T22	2	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Fri Apr 24 14:38:03 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns1I-5LVZPU8E7P1J4Bf8a1OaJcf?mbt7EAcDI8uqCCzNUj0

1-3-8 0-0 3-1-15 3-1-15 6-1-5 5-9-7 11-10-13 5-9-7 17-7-0 5-9-7 23-3-3 5-9-7 29-0-11 32-0-1 35-2-0 36-5-8 1-3-8 Scale = 1:57.7

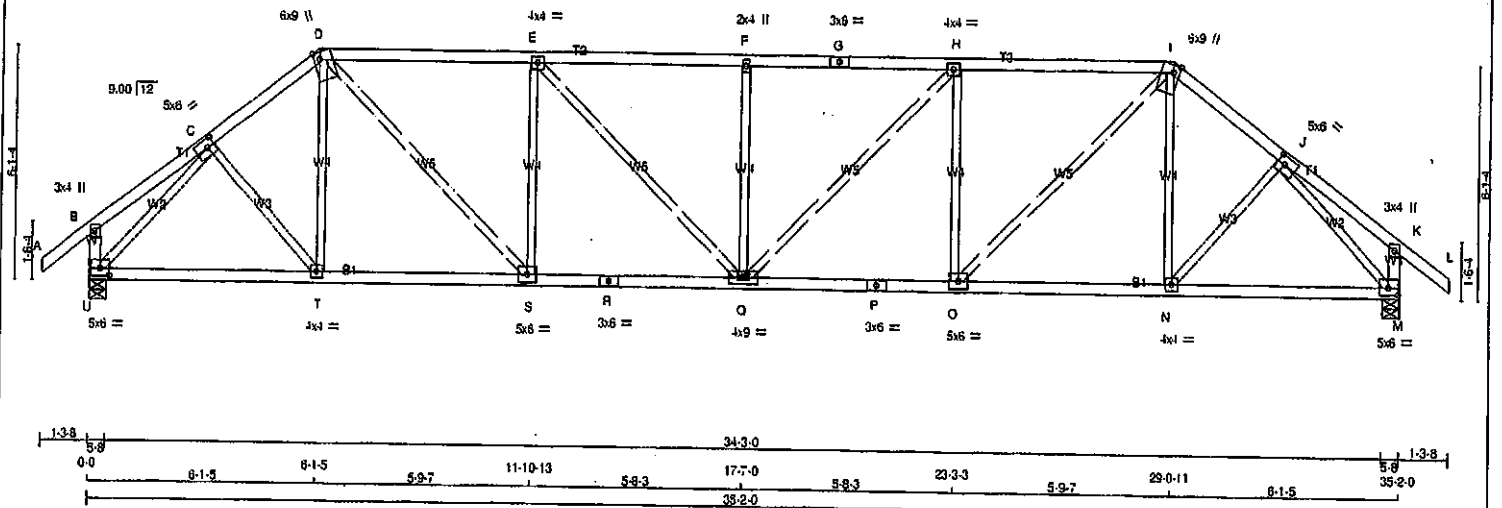

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - L	2x4	DRY	No.2
U - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
U - R	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF
DRY: SEASONED LUMBER.			

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN Y	X
B TMV+p	MT20	3.0	4.0	
C TMWW-i	MT20	5.0	6.0	2.50 2.25
D TTWW+m	MT20	6.0	9.0	Edge 2.00
E TMWW-i	MT20	4.0	4.0	
F TMWW+w	MT20	2.0	4.0	
G TS-i	MT20	3.0	6.0	
H TMWW-i	MT20	4.0	4.0	
I TTWW+m	MT20	6.0	9.0	Edge 2.00
J TMWW-i	MT20	5.0	6.0	2.50 2.25
K TMV+p	MT20	3.0	4.0	
M BMWW-i	MT20	5.0	6.0	2.25 3.00
N BMWW-i	MT20	4.0	4.0	
O BMWW-i	MT20	5.0	6.0	
P BS-i	MT20	3.0	6.0	
Q BMWW-i	MT20	4.0	9.0	
R BS-i	MT20	3.0	6.0	
S BMWW-i	MT20	5.0	6.0	
T BMWW-i	MT20	4.0	4.0	
U BMWW-i	MT20	5.0	6.0	2.25 3.00

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
U	2065	0	0	2065	0	0	5-8	5-8	5-8
M	2065	0	0	2065	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST LCASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
U	1458	970	0	0	0
M	1458	970	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.41 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	CSH (LC)	MEMB.	FORCE (LBS)	MAX	CSH (LC)
FR-TO		FROM	TO	FR-TO			
A-B	0 38	-91.8	-91.8	0.12 (1)	10.00	C-T	0 216
B-C	0 16	-91.8	-91.8	0.11 (1)	10.00	T-D	-33 59
C-D	-2150 0	-91.8	-91.8	0.17 (1)	4.50	D-S	0 1393
D-E	-2687 0	-91.8	-91.8	0.84 (1)	3.80	S-E	-885 0
E-F	-2973 0	-91.8	-91.8	0.88 (1)	3.41	E-Q	0 410
F-G	-2973 0	-91.8	-91.8	0.88 (1)	3.41	Q-F	-481 0
G-H	-2973 0	-91.8	-91.8	0.88 (1)	3.41	H-Q	0 410
H-I	-2687 0	-91.8	-91.8	0.84 (1)	3.80	O-H	-885 0
I-J	-2150 0	-91.8	-91.8	0.17 (1)	4.50	O-I	0 1393
J-K	0 16	-91.8	-91.8	0.11 (1)	10.00	N-I	-33 59
K-L	0 38	-91.8	-91.8	0.12 (1)	10.00	N-J	0 216
L-U	-240 0	0.0	0.0	0.03 (1)	7.81	U-C	-2364 0
M-K	-240 0	0.0	0.0	0.03 (1)	7.81	J-M	-2364 0
U-T	0 1557	-18.5	-18.5	0.34 (1)	10.00		
T-S	0 1702	-18.5	-18.5	0.36 (1)	10.00		
S-R	0 2887	-18.5	-18.5	0.48 (1)	10.00		
R-Q	0 2887	-18.5	-18.5	0.48 (1)	10.00		
Q-P	0 2887	-18.5	-18.5	0.48 (1)	10.00		
P-O	0 2887	-18.5	-18.5	0.48 (1)	10.00		
O-N	0 1702	-18.5	-18.5	0.36 (1)	10.00		
N-M	0 1557	-18.5	-18.5	0.34 (1)	10.00		

TOTAL WEIGHT = 2 X 152 = 304 b

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH.	LL = 25.8 PSF
BOT CH.	LL = 8.0 PSF
	DL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 39.0 PSF
SPACING = 24.0 IN. C/C	

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.16")
ALLOWABLE DEFL.(TL) = L/380 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.29")

CSI: TC=0.68/1.00 (E-F:1), BC=0.48/1.00 (O-Q:1), WB=0.80/1.00 (C-U:1), SSI=0.25/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1666


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.86 (M) INPUT = 0.90)
JSI METAL= 0.84 (P) INPUT = 1.00)



Structural component only
DWG# T-2006899

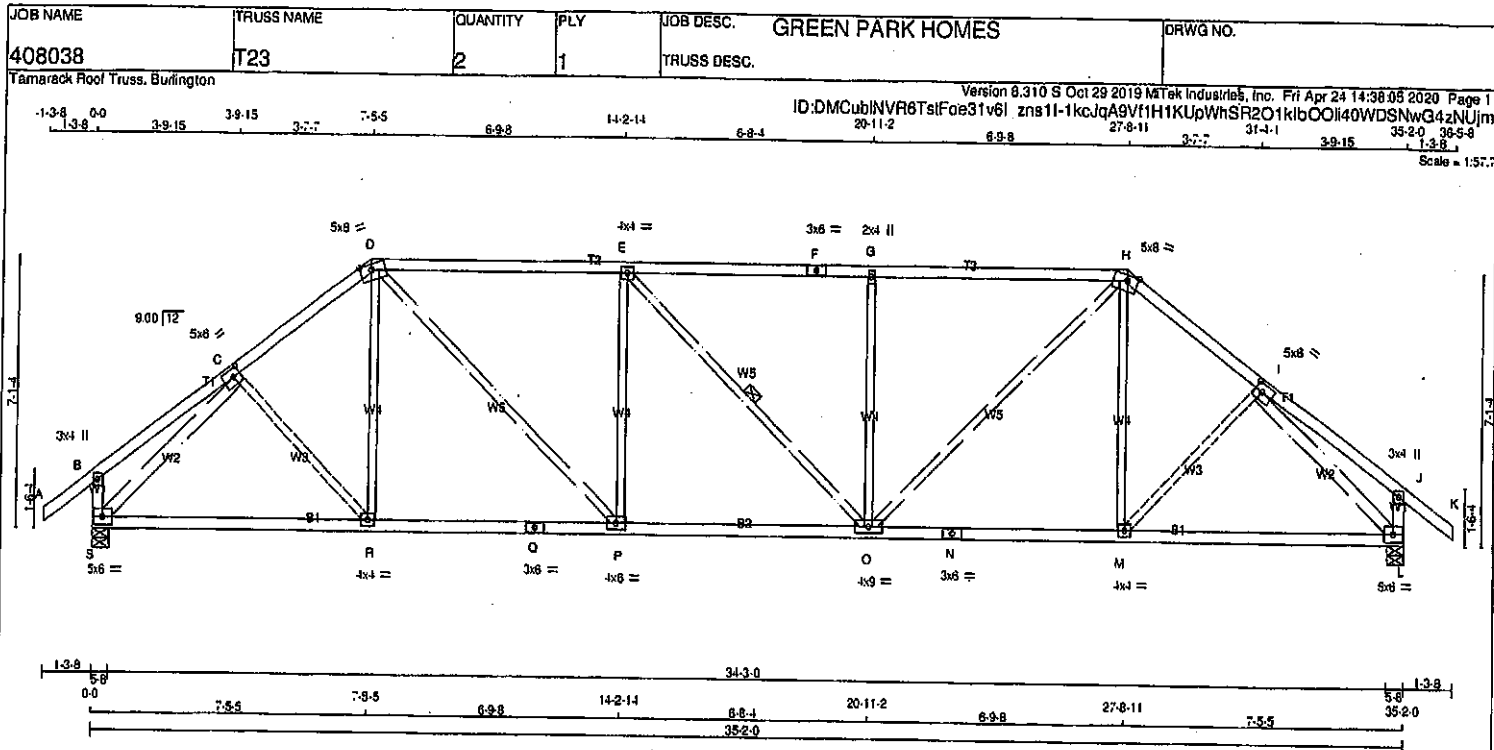

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - H	2x4	DRY No.2	SPF
H - K	2x4	DRY No.2	SPF
S - B	2x4	DRY No.2	SPF
L - J	2x4	DRY No.2	SPF
S - D	2x4	DRY No.2	SPF
Q - N	2x4	DRY No.2	SPF
N - L	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2

EXCEPT

S - C 2x4 DRY No.2

I - L 2x4 DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0	
C	TMVW-1	MT20	5.0	8.0	2.50 2.50
D	TTWW-m	MT20	5.0	8.0	Edge 3.50
E	TMVW-1	MT20	4.0	4.0	
F	TS-1	MT20	3.0	8.0	
G	TMVW-m	MT20	2.0	4.0	
H	TTWW-m	MT20	5.0	8.0	Edge 3.50
I	TMVW-1	MT20	5.0	8.0	2.50 2.50
J	TMV-p	MT20	3.0	4.0	
L	BMVW-1	MT20	5.0	8.0	
M	BMVW-1	MT20	4.0	4.0	
N	BS-1	MT20	3.0	8.0	
O	BMVW-1	MT20	4.0	8.0	
P	BMVW-1	MT20	4.0	8.0	
Q	BS-1	MT20	3.0	8.0	
R	BMVW-1	MT20	4.0	8.0	
S	BMVW-1	MT20	5.0	8.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	RECORD
S	2065	0	2065	0	0	5-8	5-8	5-8
L	2065	0	2065	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN.	COMPONENT REACTIONS
S	1458	970	0
L	1458	970	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED				MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
			VERT. LOAD	LC1	MAX	UNBRAC		
FR-TO								
A-B	0	38	-91.8	-91.8	0.12 (1)	10.00	0.03 (4)	
B-C	0	22	-91.8	-91.8	0.19 (1)	10.00	0.04 (4)	
C-D	-2138	0	-91.8	-91.8	0.27 (1)	4.41	0.25 (1)	
D-E	-2480	0	-91.8	-91.8	0.85 (1)	3.47	0.59 (1)	
E-F	-2479	0	-91.8	-91.8	0.84 (1)	3.47	0.59 (1)	
F-G	-2479	0	-91.8	-91.8	0.84 (1)	3.47	0.59 (1)	
G-H	-2479	0	-91.8	-91.8	0.84 (1)	3.49	0.59 (1)	
H-I	-2139	0	-91.8	-91.8	0.27 (1)	4.41	0.25 (1)	
I-J	0	22	-91.8	-91.8	0.19 (1)	10.00	0.03 (4)	
J-K	0	38	-91.8	-91.8	0.12 (1)	10.00	0.03 (4)	
S-B	-259	0	0.0	0.0	0.03 (1)	7.81	0.82 (1)	
L-J	-259	0	0.0	0.0	0.03 (1)	7.81	0.82 (1)	
S-R	0	1632	-18.5	-18.5	0.40 (1)	10.00		
R-Q	0	1691	-18.5	-18.5	0.41 (1)	10.00		
Q-P	0	1691	-18.5	-18.5	0.41 (1)	10.00		
P-O	0	2480	-18.5	-18.5	0.47 (1)	10.00		
O-N	0	1691	-18.5	-18.5	0.41 (1)	10.00		
N-M	0	1691	-18.5	-18.5	0.41 (1)	10.00		
M-L	0	1632	-18.5	-18.5	0.40 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17')

CALCULATED VERT. DEFL. (LL) = L/999 (0.12')

ALLOWABLE DEFL. (TL) = L/360 (1.17')

CALCULATED VERT. DEFL. (TL) = L/999 (0.25')

CSI: TC=0.85/1.00 (D-E:1), BC=0.47/1.00 (O-P:1), WB=0.82/1.00 (I-L:1), SSI=0.29/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP = 0.85 (i) INPUT = 0.90

JSI METAL = 0.59 (i) INPUT = 1.00



Structural component only
DWG# T-2006900

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408038	T25	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

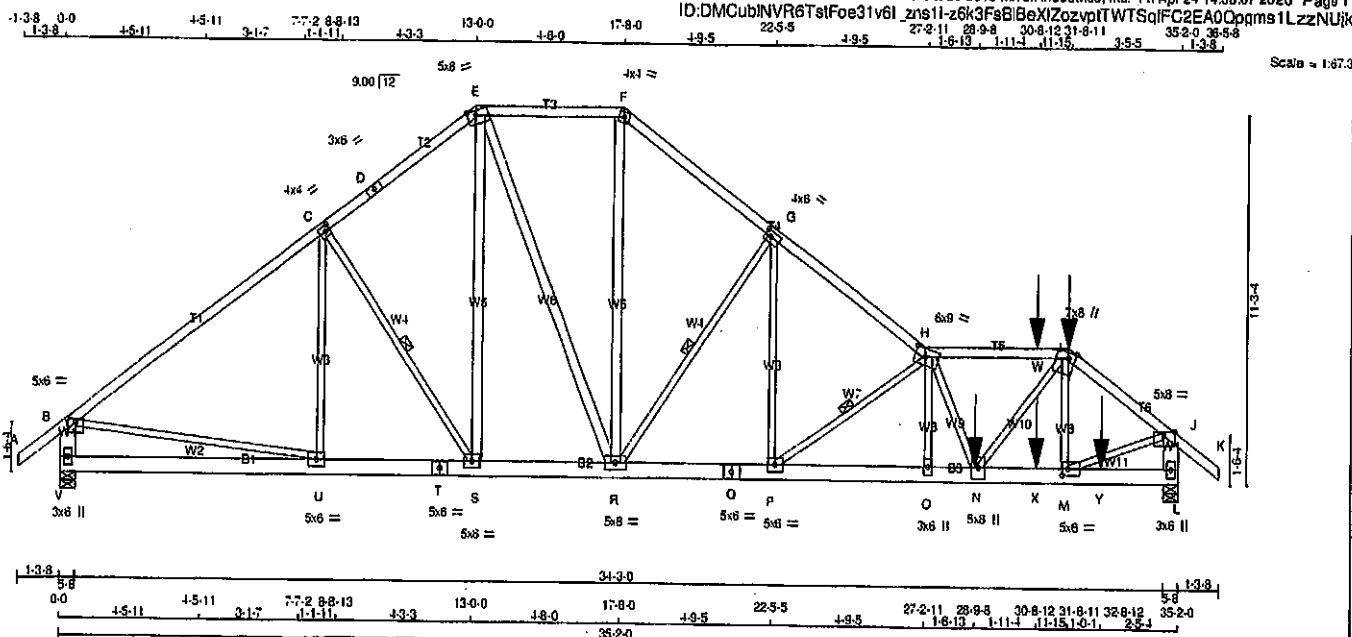

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
E - F	2x4	DRY	No.2	SPF		
F - H	2x4	DRY	No.2	SPF		
H - I	2x4	DRY	No.2	SPF		
I - K	2x4	DRY	No.2	SPF		
V - B	2x6	DRY	No.2	SPF		
L - J	2x6	DRY	No.2	SPF		
V - T	2x6	DRY	No.2	SPF		
T - Q	2x6	DRY	No.2	SPF		
Q - L	2x6	DRY	No.2	SPF		
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF		
S - E	2x4	DRY	No.2	SPF		
E - R	2x4	DRY	No.2	SPF		
R - F	2x4	DRY	No.2	SPF		

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - D	12	TOP
E - F	12	TOP
F - H	12	TOP
H - I	12	TOP
V - B	12	SIDE(61.0)
L - J	12	SIDE(61.0)
Q - L	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
V - T	12	TOP
T - Q	12	TOP
Q - L	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	
2x4	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
V	2825	0	2825	0
L	4815	0	4815	0

UNFACTORED REACTIONS

	1ST LOASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
V	1853	1235	0	0	0	0	0	
L	3397	2275	0	0	0	0	0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.39 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, G-R, H-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED HORZ. LOAD (LBS)	MAX. UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED HORZ. LOAD (LBS)
FR-TO						FR-TO				
A-B	0	38	-91.8	-91.8	0.07 (1)	10.00	C-S	-487	0	0.13 (1)
B-C	-2954	0	-91.8	-91.8	0.77 (1)	4.70	S-E	0	457	0.04 (1)
C-D	-2732	0	-91.8	-91.8	0.51 (1)	4.88	E-R	0	901	0.08 (1)
D-E	-2732	0	-91.8	-91.8	0.51 (1)	4.88	R-F	0	1471	0.13 (1)
E-F	-2478	0	-91.8	-91.8	0.22 (1)	5.49	F-G	-2604	0	0.69 (1)
F-G	-3106	0	-91.8	-91.8	0.26 (1)	5.01	P-G	0	2685	0.33 (1)
G-H	-4856	0	-91.8	-91.8	0.34 (1)	4.11	P-H	-4242	0	0.58 (1)
H-W	-6892	0	-91.8	-91.8	0.43 (1)	3.39	O-H	0	126	0.02 (1)
W-I	-6892	0	-91.8	-91.8	0.43 (1)	3.39	M-I	-1031	0	0.13 (1)
I-J	-5307	0	-91.8	-91.8	0.22 (1)	-1.05	B-U	0	2419	0.30 (1)
J-K	0	38	-91.8	-91.8	0.07 (1)	10.00	M-J	0	-438	0.55 (1)
V-B	-2555	0	0.0	0.0	0.09 (1)	7.81	N-I	0	4422	0.55 (1)
L-J	-4804	0	0.0	0.0	0.17 (1)	6.61	H-N	-926	0	0.13 (1)
							U-C	-187	59	0.10 (1)
V-U	0	0	-18.5	-18.5	0.07 (1)	10.00				
U-T	0	2397	-18.5	-18.5	0.17 (1)	10.00				
T-S	0	2397	-18.5	-18.5	0.17 (1)	10.00				
S-R	0	2131	-18.5	-18.5	0.18 (1)	10.00				
R-Q	0	3916	-18.5	-18.5	0.29 (1)	10.00				
Q-P	0	3916	-18.5	-18.5	0.29 (1)	10.00				
P-O	0	7267	-18.5	-18.5	0.55 (1)	10.00				
O-N	0	7271	-18.5	-18.5	0.50 (1)	10.00				
N-X	0	4205	-18.5	-18.5	0.40 (1)	10.00				
X-M	0	4205	-18.5	-18.5	0.40 (1)	10.00				
M-Y	0	0	-18.5	-18.5	0.04 (1)	10.00				
Y-L	0	0	-18.5	-18.5	0.04 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
I	31-8-11	-44	-48	---	FRONT	VERT	DEAD	C1
I	31-8-11	-222	-222	---	FRONT	VERT	SNOW	C1
N	28-9-8	-2881	-2881	---	FRONT	VERT	TOTAL	C1
W	30-8-12	-111	-111	---	FRONT	VERT	TOTAL	C1
X	30-8-12	-26	-26	---	FRONT	VERT	TOTAL	C1
Y	32-8-12	-26	-26	---	FRONT	VERT	TOTAL	C1

TOTAL WEIGHT = 2 X 206 = 412 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD	= 39.0	PSF	

SPACING = 24.0 IN. O.C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00:12

*** NON STANDARD GIRDER ***
ADDTL. USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/899 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/899 (0.25")

CSI: TC=0.77 1.00 (B-C:1), BC=0.60:1.00 (N-O:1), WB=0.69:1.00 (G-R:1), SS=0.15:1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	618	354
	1687	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (P) (INPUT = 0.90)
JSI METAL= 0.55 (N) (INPUT = 1.00)



Structural component only
DWG# T-2006902 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408038	T25	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 14:38:07 2020 Page 2
ID:DMCubINVR6TstFoe31v6l zns11-z6k3FsBIBeXIZozvp(TWTSofFC2EA0Cqoms1LzzNUjk

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	6.0	1.25	3.00
C	TMWW-I	MT20	4.0	4.0	2.00	1.50
D	TS-I	MT20	3.0	6.0		
E	TTWW-m	MT20	5.0	8.0	1.75	3.25
F	TTW-m	MT20	4.0	4.0		
G	TMWW-I	MT20	4.0	6.0	2.00	2.25
H	TTWW-m	MT20	6.0	9.0	3.00	4.00
I	TTWW-m	MT20	7.0	8.0	Edge	2.50
J	TMWV-p	MT20	5.0	8.0	Edge	
L	BMV1+p	MT20	3.0	6.0		
M	BMWW-I	MT20	5.0	6.0	2.50	2.00
N	BMWW-I	MT20	5.0	8.0		
O	BMW-w	MT20	3.0	6.0		
P, S, U						
P	BMWW-I	MT20	5.0	6.0		
Q	BS-I	MT20	5.0	6.0		
R	BMWW-I	MT20	5.0	8.0		
T	BS-I	MT20	5.0	6.0		
V	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2006902 72

JOB NAME 408038	TRUSS NAME T26	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 5 Oct 29 2019 MITek Industries, Inc. Fri Apr 24 14:38:08 2020 Page 2 ID:DMCubINVR8TstFoe31v6l zns11-SJIRSCCNxvIbByY5Ma 10IMxycSrvRvzvQcbtPzNUji	

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	1.25	3.00
C	TMWW-l	MT20	4.0	4.0	2.00	1.50
D	TTW+m	MT20	4.0	4.0		
E	TTWW-m	MT20	5.0	6.0		
F	TTWW-m	MT20	5.0	6.0	2.00	2.00
G	TMW+w	MT20	2.0	4.0		
H	TTWW+m	MT20	5.0	6.0	2.25	1.50
I	TMWW-l	MT20	4.0	4.0	2.00	1.50
J	TMVW+p	MT20	5.0	6.0	Edge	
L	BMV1+p	MT20	3.0	6.0		
M, N, Q, S						
M	BMWW-l	MT20	5.0	6.0		
O	BMWWWW-l	MT20	5.0	6.0		
P	BS-l	MT20	6.0	6.0		
R	BMWWWW-l	MT20	5.0	6.0		
T	BMV1+p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

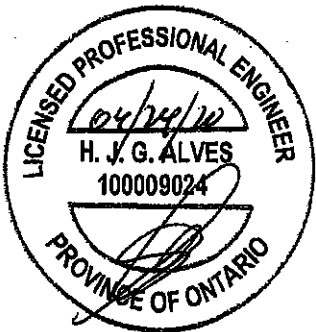

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408038	T27	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 14:38:09 2020 Page 1
ID:DMCubINVR6TstFoe31v6l zns1l-wVsgYC7IfnSo66tlwV Yv6PonLev3674L8QszNUj

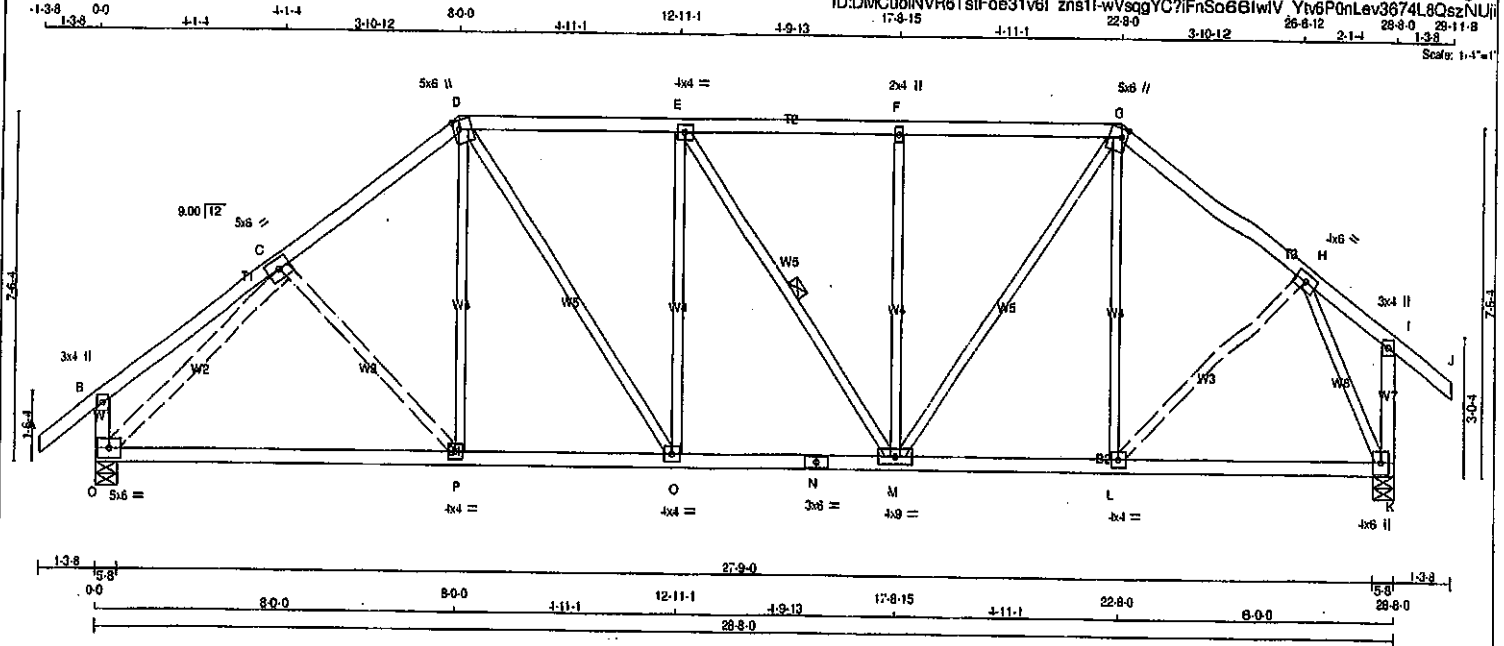

LUMBER				DESCR.	
N. L. G. A. RULES					
CHORDS	SIZE	LUMBER		SPF	
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
G - J	2x4	DRY	No.2	SPF	
Q - B	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
Q - N	2x4	DRY	No.2	SPF	
N - K	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
Q - C	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMWW-I	MT20	5.0	6.0	
D	TTWW+m	MT20	5.0	6.0	2.25 1.50
E	TMWW-I	MT20	4.0	4.0	
F	TMV+w	MT20	2.0	4.0	
G	TTWW+m	MT20	5.0	6.0	2.25 1.50
H	TMWW-I	MT20	4.0	6.0	
I	TMV+p	MT20	3.0	4.0	
K	BMVW1+p	MT20	4.0	6.0	
L, O, P					
L	BMWW-I	MT20	4.0	4.0	
M	BMWW-I	MT20	4.0	6.0	
N	BS-I	MT20	3.0	6.0	
Q	BMVW1-I	MT20	5.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	BRG	IN-SX	BRG	IN-SX
Q	1707	0	1707	0	0	5-8	5-8	5-8	5-8
K	1707	0	1707	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
Q	1205	804	0	0	0	401	0	0	0
K	1205	804	0	0	0	401	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.85 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-M

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)	MAX	LC1 (LBS)
FR-TO		FROM	TO	FR-TO			
A-B	0.38	-91.8	-91.8	10.00	C-P	-51	35
B-C	0.25	-91.8	-91.8	10.00	P-D	0	187
C-D	-1625	0	0	4.90	D-O	0	538
D-E	-1583	0	0	4.85	O-E	-375	0
E-F	-1510	0	0	4.95	E-M	-132	0
F-G	-1510	0	0	4.88	M-F	-482	0
G-H	-1337	0	0	5.38	M-G	0	816
H-I	0.38	-91.8	-91.8	10.00	L-G	-222	0
I-J	0.38	-91.8	-91.8	10.00	L-H	0	480
Q-B	-267	0	0	7.81	Q-C	-1903	0
K-I	-158	0	0	7.81	H-K	-1685	0
Q-P	0	1313	-18.5	-18.5	0.36	4	10.00
P-O	0	1280	-18.5	-18.5	0.37	4	10.00
O-N	0	1583	-18.5	-18.5	0.30	11	10.00
N-M	0	1583	-18.5	-18.5	0.30	11	10.00
M-L	0	1050	-18.5	-18.5	0.26	11	10.00
L-K	0	717	-18.5	-18.5	0.21	4	10.00

TOTAL WEIGHT = 139 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.98")
CALCULATED VERT. DEFL(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.98")
CALCULATED VERT. DEFL(TL) = L/999 (0.16")

CSK: TC=0.35/1.00 (D-E:1), BC=0.37/1.00 (O-P:4), WB=0.75/1.00 (C-Q:1), SSI=0.21/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1867
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.83 (H) (INPUT = 0.90)
JSI METAL = 0.53 (N) (INPUT = 1.00)

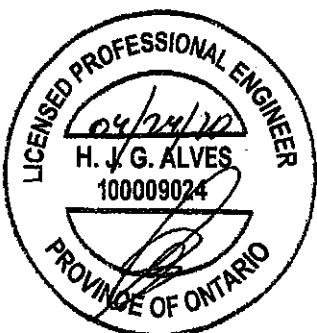

Structural component only
DWG# T-2006904

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408038	T29	1	1	GREEN PARK HOMES		

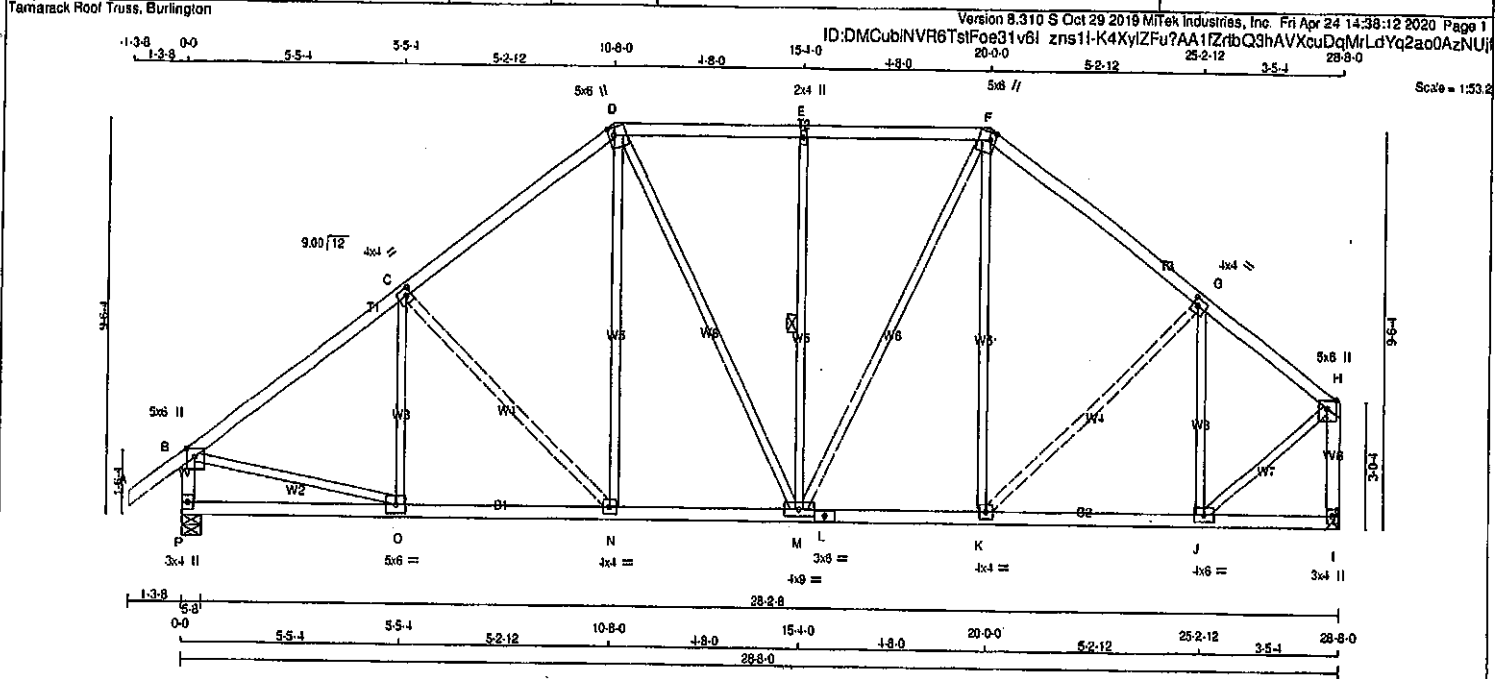

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
P - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
P - L	2x4	DRY	No.2
L - I	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	2.50 2.25
C	TMVW-1	MT20	4.0	4.0	2.00 1.50
D	TTWW+m	MT20	5.0	8.0	2.25 1.50
E	TMVW+m	MT20	2.0	4.0	
F	TTWW+m	MT20	5.0	8.0	2.25 1.50
G	TMVW-1	MT20	4.0	4.0	2.00 1.50
H	TMVW+p	MT20	5.0	6.0	Edge
I	BMV1+p	MT20	3.0	4.0	
J	BMVW-1	MT20	4.0	6.0	
K	BMVW-1	MT20	4.0	4.0	
L	BS-1	MT20	3.0	6.0	
M	BMVW-1	MT20	4.0	9.0	
N	BMVW-1	MT20	4.0	4.0	
O	BMVW-1	MT20	5.0	8.0	
P	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG					
	VERT	HORZ	DOWN	HORZ UPLIFT	IN-SX	IN-SX			
P	1707	0	1707	0	5-8	5-8			
I	1580	0	1580	0	MECHANICAL				

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS							
JT	1ST CASE COMBINED	MAX. MIN. SNOW	MIN. LIVE	PERM. LIVE	WIND	DEAD	SOIL
P	1205	804	0	0	0	401	0
I	1118	733	0	0	0	384	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.69 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 -38	-91.8 -91.8	0.12 (1)	10.00	O-C	-185 23	0.09 (1)
B-C	-1702 0	-91.8 -91.8	0.39 (1)	4.69	C-N	-337 0	0.38 (1)
C-D	-1476 0	-91.8 -91.8	0.37 (1)	4.99	N-D	0 329	0.07 (1)
D-E	-1249 0	-91.8 -91.8	0.27 (1)	5.45	D-M	0 211	0.05 (1)
E-F	-1249 0	-91.8 -91.8	0.27 (1)	5.45	M-E	-519 0	0.31 (1)
F-G	-1332 0	-91.8 -91.8	0.32 (1)	5.26	M-F	0 -457	0.10 (1)
G-H	-1158 0	-91.8 -91.8	0.28 (1)	5.82	K-F	0 73	0.03 (4)
P-B	-1685 0	0.0 0.0	0.17 (1)	6.42	K-G	0 119	0.03 (1)
I-H	-1557 0	0.0 0.0	0.25 (1)	6.80	J-G	-662 0	0.31 (1)
					B-O	0 1422	0.32 (1)
					J-H	0 1216	0.27 (1)
P-O	0 0	-18.5 -18.5	0.13 (4)	10.00			
O-N	0 -1389	-18.5 -18.5	0.28 (1)	10.00			
N-M	0 1154	-18.5 -18.5	0.23 (1)	10.00			
M-L	0 1043	-18.5 -18.5	0.22 (1)	10.00			
L-K	0 1043	-18.5 -18.5	0.22 (1)	10.00			
K-J	0 958	-18.5 -18.5	0.21 (1)	10.00			
J-I	0 0	-18.5 -18.5	0.08 (4)	10.00			

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF
SPACING = 24.0 IN. C/C	

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, GSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.98")

CALCULATED VERT. DEFL.(LL) = L/999 (0.05")

ALLOWABLE DEFL.(TL) = L/360 (0.98")

CALCULATED VERT. DEFL.(TL) = L/999 (0.09")

CSI: TC=0.39/1.00 (B-C:1), BC=0.28/1.00 (N-O:1), WB=0.38/1.00 (C-N:1), SS=0.21/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	818 354	1687 786	1987 1656


PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (B) (INPUT = 0.90)

JSI METAL = 0.44 (H) (INPUT = 1.00)





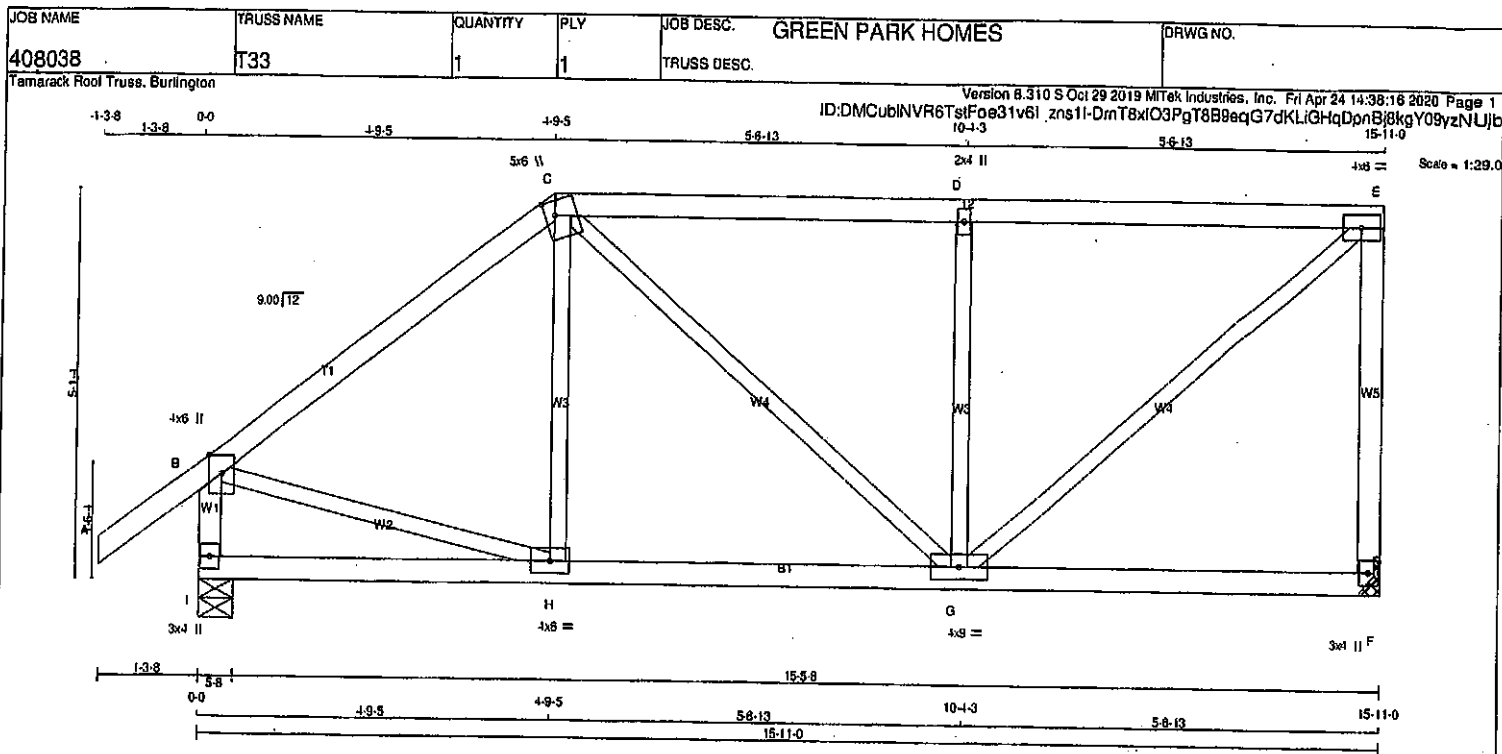

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
F - E	2x4	DRY No.2	SPF
I - B	2x4	DRY No.2	SPF
I - F	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMWW+p	MT20	4.0	8.0	Edge
C	TTWW+m	MT20	5.0	6.0	2.25 1.50
D	TMWW+w	MT20	2.0	4.0	
E	TMWW-i	MT20	4.0	6.0	
F	BMV1+p	MT20	3.0	4.0	
G	BMWWW-i	MT20	4.0	9.0	
H	BMWW-i	MT20	4.0	6.0	
I	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	UP		
F	877	0	877	0	MECHANICAL	IN-SX
I	1004	0	1004	0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3-8.

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX. MIN. COMPONENT REACTIONS					DEAD	SOIL
		SNOW	LIVE	PERM. LIVE	WIND	IN-SX		
F	621	407	0	0	0	0	213	0
I	708	478	0	0	0	0	230	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.13 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS			WEBS		
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB. FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
A-B	0	38	-91.8	-91.8	0.12 (1)	10.00
B-C	-781	0	-91.8	-91.8	0.39 (4)	8.25
C-D	-744	0	-91.8	-91.8	0.50 (1)	6.13
D-E	-744	0	-91.8	-91.8	0.50 (1)	6.13
E-F	-834	0	0	0	0.37 (1)	7.81
F-B	-968	0	0	0	0.10 (1)	7.81
I-H	0	0	-18.5	-18.5	0.11 (4)	10.00
H-G	0	822	-18.5	-18.5	0.19 (4)	10.00
G-F	0	0	-18.5	-18.5	0.13 (4)	10.00

TOTAL WEIGHT = 89 lb

(M)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.53")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.53")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSI: TC=0.50:1.00 (D-E:1), BC=0.19:1.00 (G-H:4), WB=0.24:1.00 (D-G:1), SSI=0.25:1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR SECTION (PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.67 (B) (INPUT = 0.90)
JSI METAL = 0.44 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006910

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408038	T35	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Fri Apr 24 14:38:18 2020 Page 1
ID:DMCubINVR6TstFoe31v6f zns1l-9EvDZdJeb0wBNUI0yhA5QmndQevTF7IRC_16EqzNUJZ

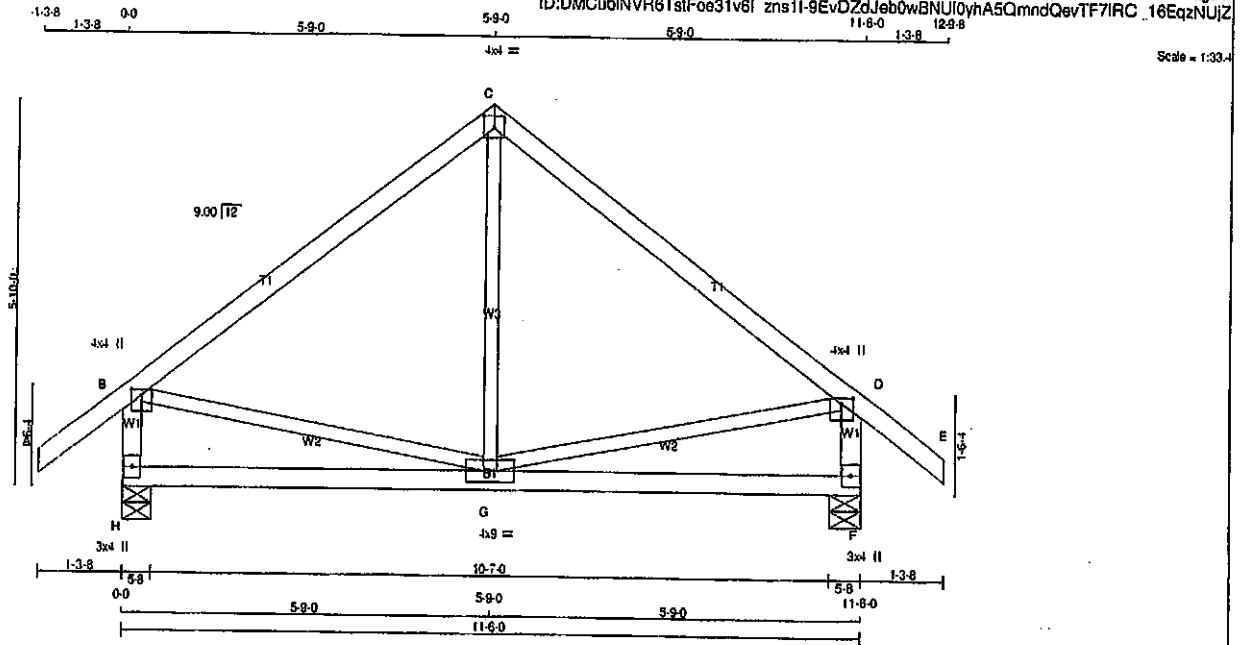

Scale = 1:33.4

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2			SPF
C - E	2x4 DRY	No.2			SPF
H - B	2x4 DRY	No.2			SPF
F - D	2x4 DRY	No.2			SPF
H - F	2x4 DRY	No.2			SPF
ALL WEBS	2x3 DRY	No.2			SPF
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVV+p	MT20	4.0	4.0	1.00	2.00
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TMVV+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMWWV-1	MT20	4.0	9.0		
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
H	760	0	760	0	5-8	5-8
F	760	0	760	0	5-8	5-8

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW.	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	535	385 0	0 0	0 0	0 0	171 0	0 0
F	535	385 0	0 0	0 0	0 0	171 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		MAX. UNBRACED LENGTH	MEMB.	WEBS	
	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	VERT. LOAD (PLF)	CS1 (LC)			MAX. FACTORED FORCE (LBS)	CS1 (LC)
FR-TO						FR-TO		
A-B	0 38	-91.8	-91.8	0.12 (1)	10.00	G-C	-12 95	0.03 (4)
B-C	-430 0	-91.8	-91.8	0.39 (1)	6.25	B-G	0 351	0.08 (1)
C-D	-430 0	-91.8	-91.8	0.39 (1)	6.25	G-D	0 351	0.08 (1)
D-E	0 38	-91.8	-91.8	0.12 (1)	10.00			
H-B	-720 0	0.0	0.0	0.08 (1)	7.81			
F-D	-720 0	0.0	0.0	0.08 (1)	7.81			
H-G	0 0	-18.5	-18.5	0.17 (4)	10.00			
G-F	0 0	-18.5	-18.5	0.17 (4)	10.00			

TOTAL WEIGHT = 2 X 49 = 98 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.38")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.38")
CALCULATED VERT. DEFL. (TL) = L/889 (0.03")

CS1: TC=0.39/1.00 (B-C:1), BC=0.17/1.00 (F-G:4), WB=0.09/1.00 (D-G:1), SS1=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1887 788	1887 1856


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.68 (D) (INPUT = 0.90)
JSI METAL = 0.17 (D) (INPUT = 1.00)

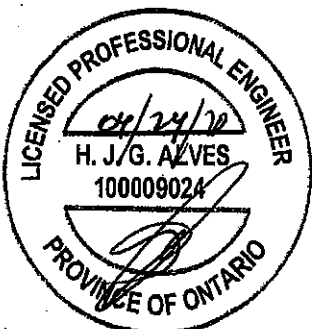

Structural component only
DWG# T-2006912

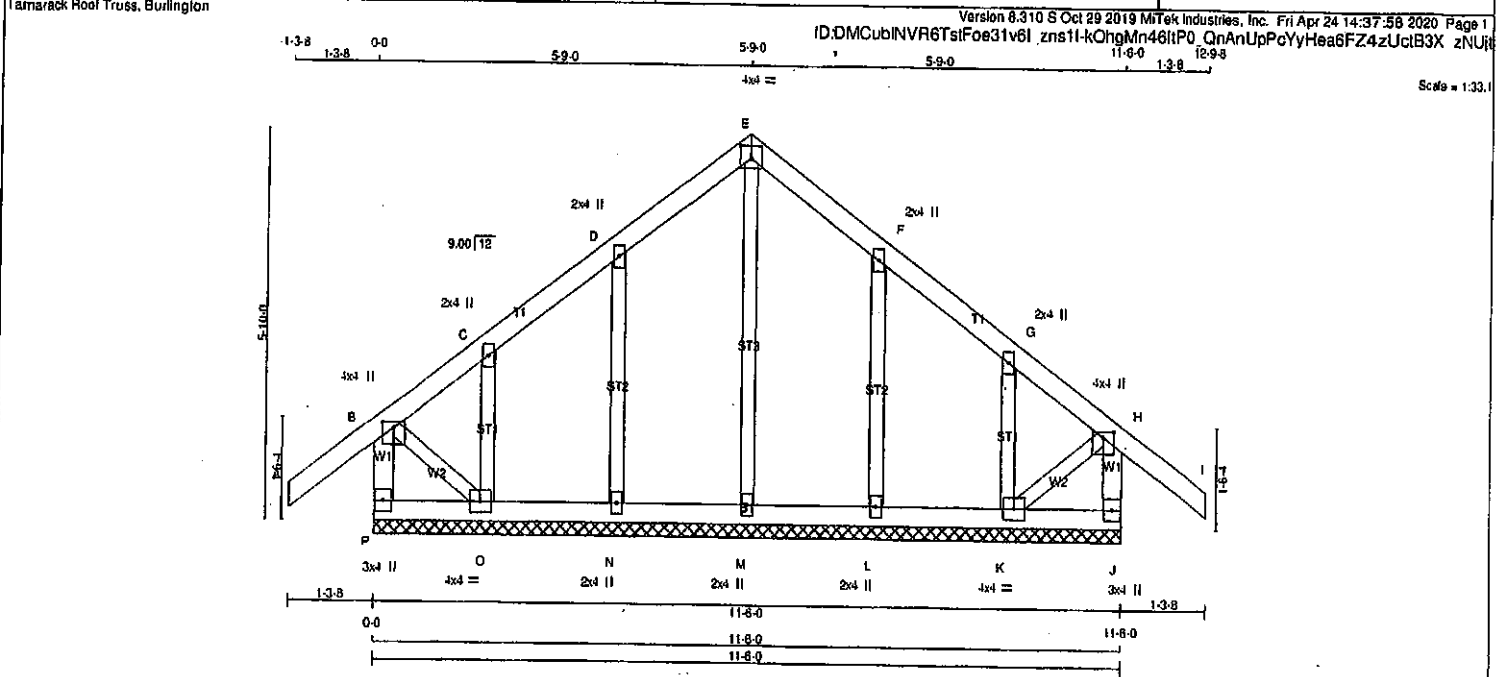

LUMBER

CHORDS	SIZE	DRY	LUMBER	DESCR.
P - B	2x4	DRY	No.2	SPF
A - E	2x4	DRY	No.2	SPF
E - I	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
P - J	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
ALL GABLE WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C, D, F, G						
C	TMW+w	MT20	2.0	4.0		
E	TTW+p	MT20	4.0	4.0	2.25	2.00
H	TMVW+p	MT20	4.0	4.0	1.00	2.00
J	BMV1+p	MT20	3.0	4.0		
K	BMWW1-l	MT20	4.0	4.0		
L, M, N						
L	BMW1+w	MT20	2.0	4.0		
O	BMWW1-l	MT20	4.0	4.0		
P	BMV1+p	MT20	3.0	4.0		

DESIGN CRITERIA

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	UNBRACED LENGTH
FR-TO				FR-TO			
P-B	-273.0	0.0	0.03 (1)	M-E	-138.0	0.07 (1)	7.81
A-B	0.38	-91.8	-91.8 0.12 (1)	N-D	-222.0	0.06 (1)	10.00
B-C	-49.0	-91.8	-91.8 0.12 (1)	O-C	-102.0	0.02 (1)	6.25
C-D	-8.0	-91.8	-91.8 0.08 (1)	L-F	-222.0	0.06 (1)	10.00
D-E	-22.0	-91.8	-91.8 0.08 (1)	K-G	-102.0	0.02 (1)	6.25
E-F	-22.0	-91.8	-91.8 0.08 (1)	B-O	0.20	0.00 (1)	10.00
F-G	-8.0	-91.8	-91.8 0.08 (1)	K-H	0.20	0.00 (1)	6.25
G-H	-49.0	-91.8	-91.8 0.12 (1)				
H-I	0.38	-91.8	-91.8 0.12 (1)				
J-H	-273.0	0.0	0.03 (1)				
P-O	0.0	-18.5	-18.5 0.02 (4)				
O-N	0.13	-18.5	-18.5 0.02 (4)				
N-M	0.8	-18.5	-18.5 0.01 (4)				
M-L	0.8	-18.5	-18.5 0.01 (4)				
L-K	0.13	-18.5	-18.5 0.02 (4)				
K-J	0.0	-18.5	-18.5 0.02 (4)				

TOTAL WEIGHT = 53 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CS1: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (N-D:4), WB=0.07/1.00 (E-M:1), SSI=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1887 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.21 (B), INPUT = 0.90

JSI METAL= 0.12 (D), INPUT = 1.00



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408038	T36	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

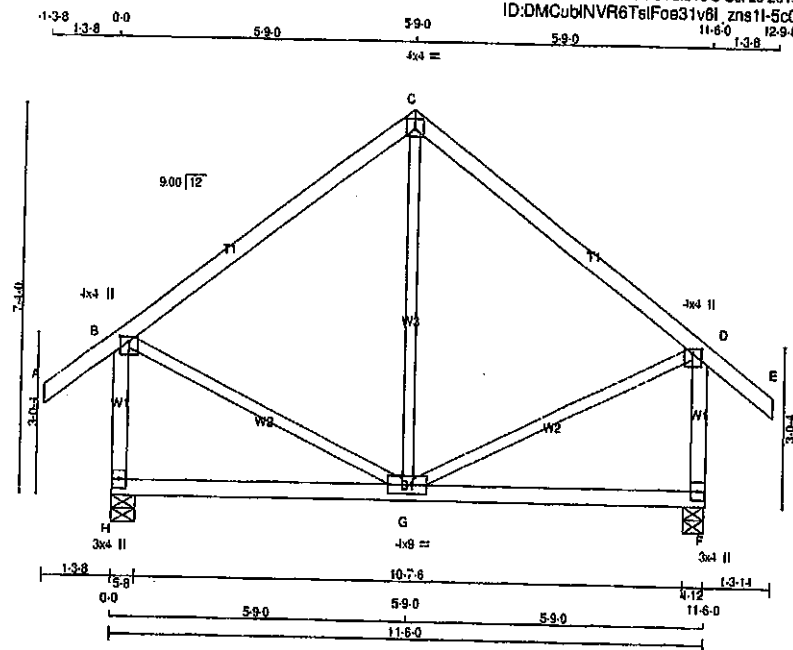

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Fri Apr 24 14:38:20 2020 Page 1
ID:DMCubINVR6T6lF0e31v8l_zns1l-5c0_zLlv7eAvdoSP35CZV8szyRbv1(kfIWDI)zNUjX

Scale = 1:41.5

LUMBER			
N. L. G. A. RULES	SIZE	DRY	NO. 2
CHORDS	2x4	DRY	No. 2
A - C	2x4	DRY	No. 2
C - E	2x4	DRY	No. 2
H - B	2x4	DRY	No. 2
F - D	2x4	DRY	No. 2
H - F	2x4	DRY	No. 2

ALL WEBS 2x3 DRY No. 2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-I	MT20	4.0	9.0		
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
H	760	0	760	0
F	760	0	760	0

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
H	535	365 0	0 0	0 0	171 0	0 0
F	535	365 0	0 0	0 0	171 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FORCE (LBS)	VERT. LOAD LC1	MAX. FACTORED	MEMB.	MAX. FACTORED	FORCE (LBS)
FR-TO							
A-B	0 38	-91.8	-91.8 0.12 (1)	10.00	G-C	-122 54	0.11 (1)
B-C	-338 0	-91.8	-91.8 0.39 (1)	8.25	B-G	0 299	0.07 (1)
C-D	-338 0	-91.8	-91.8 0.39 (1)	8.25	G-D	0 299	0.07 (1)
D-E	0 38	-91.8	-91.8 0.12 (1)	10.00			
H-B	-720 0	0.0	0.0 0.12 (1)	7.81			
F-D	-720 0	0.0	0.0 0.12 (1)	7.81			
H-G	0 0	-18.5	-18.5 0.18 (4)	10.00			
G-F	0 0	-18.5	-18.5 0.18 (4)	10.00			

TOTAL WEIGHT = 3 X 55 = 164 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 8.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.38")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.38")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.39/1.00 (B-C:1), BC=0.18/1.00 (G-H:4),
WB=0.11/1.00 (C-G:1), SS=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	618	354	1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.59 (D) (INPUT = 0.90)
JSI METAL = 0.15 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006913

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408038	T37S	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Fri Apr 24 14:38:21 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-ZpaMBaMXu1lEy1bdpio1PPC4nXSSU0uyFn9zNUjW

Scale = 1:43.5

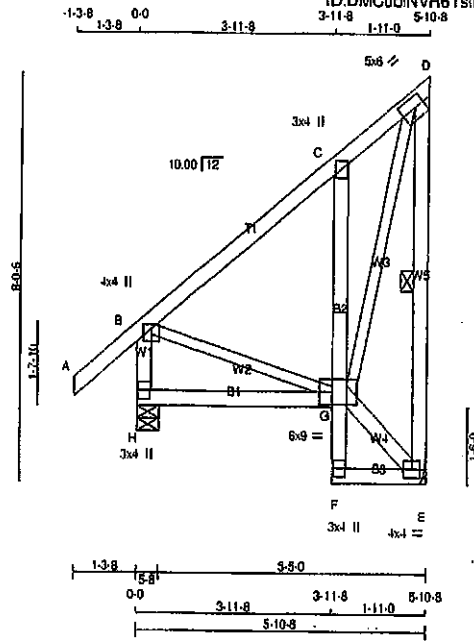

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
H - B	2x4 DRY	No.2	SPF
A - D	2x4 DRY	No.2	SPF
E - D	2x4 DRY	No.2	SPF
H - G	2x4 DRY	No.2	SPF
F - C	2x4 DRY	No.2	SPF
F - E	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			
G - E	2x4 DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
C	TMV+p	MT20	3.0	4.0	
D	TMVW-1	MT20	5.0	6.0	2.50 2.50
E	BMVW1+	MT20	4.0	4.0	
F	BMV+p	MT20	3.0	4.0	
G	BMVWWW-1	MT20	6.0	9.0	3.00 3.00
H	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG	BRG
H	451	0	451	0	0	5-8	5-8		
E	324	0	324	0	0	MECHANICAL			

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
H	317	221	0	0	0
E	229	150	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-E.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING		TOTAL LOAD CASES: (4)	
CHORDS		WEBS	
MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)
FR-TO		FR-TO	
H-B	-413 0	B-G	0 122
A-B	0 41	G-E	-13 0
B-C	-131 0	G-D	0 384
C-D	-181 0		
E-D	-299 0		
H-G	0 0		
F-G	0 18		
G-C	-360 0		
F-E	0 10		

TOTAL WEIGHT = 3 X 44 = 133 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.17/1.00 (B-C:1), BC=0.09/1.00 (G-H:4),

WB=0.09/1.00 (D-G:1), SSI=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.33 (B) INPUT = 0.90
JSI METAL = 0.13 (C) INPUT = 1.00




Structural component only
DWG# T-2006914

JOB NAME 408038	TRUSS NAME T38S	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 9.310 5 Oct 2019 Mittek Industries, Inc. Fri Apr 24 14:38:22 2020 Page 1
ID:DMCubINVR6TstFos31v6l_zns11-178kO_M9eFCs6coBWE1acxLPFHhByA07c7KNbzNUjV

Scale = 1:36.8

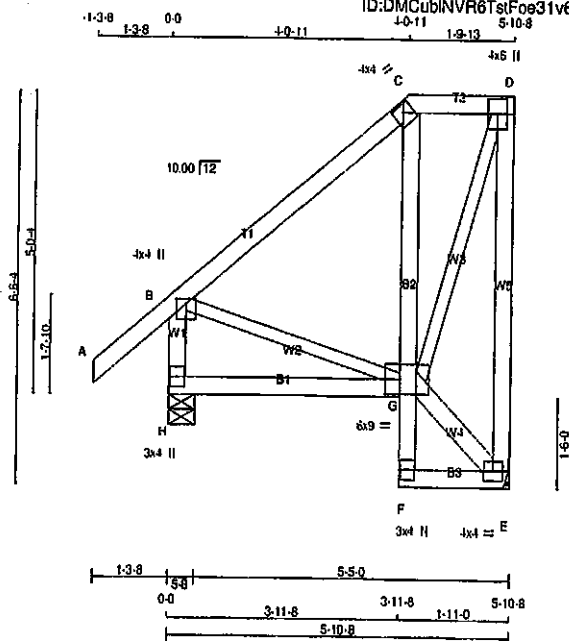

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF		
C - D	2x4 DRY	No.2	SPF		
E - D	2x4 DRY	No.2	SPF		
H - B	2x4 DRY	No.2	SPF		
H - G	2x4 DRY	No.2	SPF		
F - C	2x4 DRY	No.2	SPF		
F - E	2x4 DRY	No.2	SPF		
ALL WEBS EXCEPT	2x4 DRY	No.2	SPF		
G - D	2x3 DRY	No.2	SPF		
B - G	2x3 DRY	No.2	SPF		

DRY: SEASONED LUMBER.

PLATES (table in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTV-h	MT20	4.0	4.0	1.50	2.00
D	TMVW+p	MT20	4.0	6.0		
E	BMVW-i	MT20	4.0	4.0		
F	BMV+p	MT20	3.0	4.0		
G	BMVWW-i	MT20	6.0	9.0	3.00	3.00
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	RECORD
JT	VERT	HORZ	DOWN	HORZ
E	324	0	324	0
H	451	0	451	0

A SUITABLE HANGER-MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	229	150	0	0	0	0	79	0
H	317	221	0	0	0	0	95	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. CS1 (LC)	MAX. UNBRAC LENGTH	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO						FR-TO			
A-B	0	41	-91.8	-91.8	0.13 (1)	10.00	G-E	-6	0
B-C	-117	0	-91.8	-91.8	0.25 (1)	8.25	G-D	0	233
C-D	-82	0	-91.8	-91.8	0.06 (1)	8.25	B-G	0	94
E-D	-303	0	0	0	0.28 (1)	7.81			
H-B	-413	0	0	0	0.04 (1)	7.81			
H-G	0	0	-18.5	-18.5	0.09 (4)	10.00			
F-G	0	18	0	0	0.01 (1)	10.00			
G-C	-198	0	0	0	0.02 (1)	7.81			
F-E	0	5	-18.5	-18.5	0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	8.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CS1: TC=0.28:1.00 (D-E:1), BC=0.09:1.00 (G-H:4), WB=0.05:1.00 (D-G:1), SS=0.11:1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	618	354
	1667	788
	1987	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.33 (B) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006915

JOB NAME 408038	TRUSS NAME T40	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 24 14:38:24 2020 Page 1
 ID:DMCubiNVR6TstFoe31v6I_zns11-_OGVopOPAsqK6PmAtxGVf11qR3xifonJawURRzNUIT
 1-3-6 1-3-8 0-0 1-9-10 1-10-0 3-7-10 2-0-0 5-7-10 5-9-0 1-10-10 7-7-10 2-0-12 9-8-6 1-9-10 11-8-0 1-3-8 12-9-8
 Scale = 1:21.5

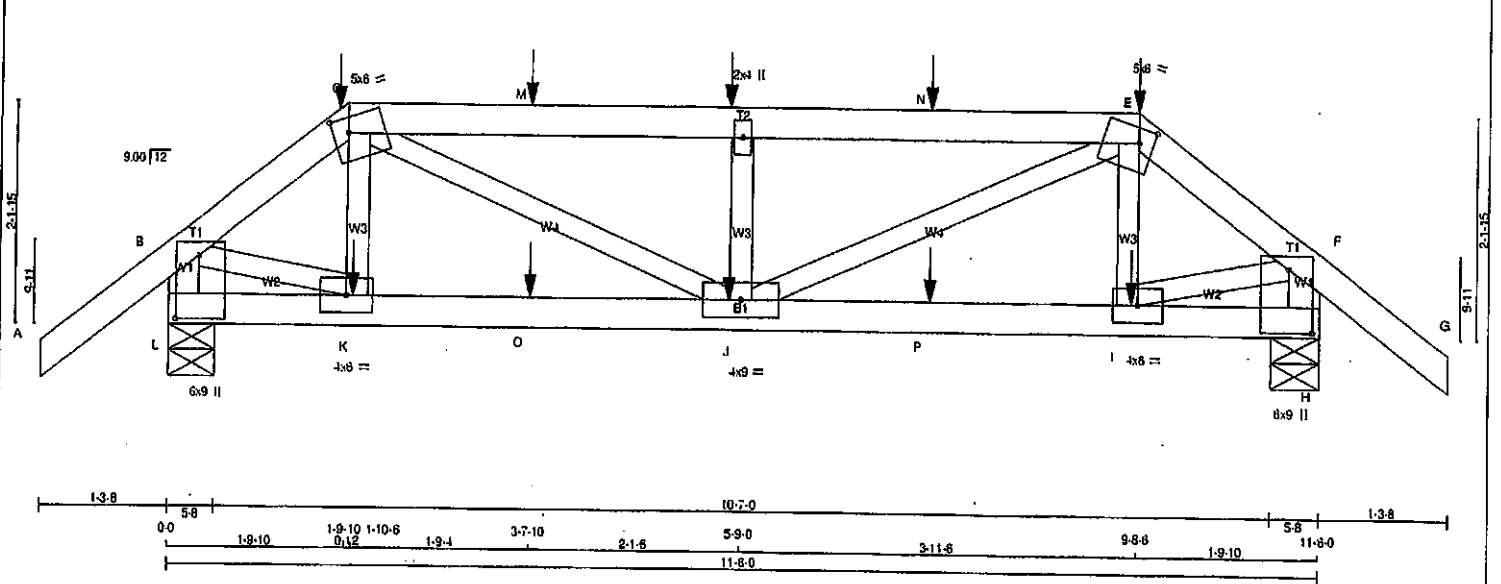

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF
 EXCEPT
 DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B, F, H, L				
C	TTWW-m	MT20	5.0	6.0 1.75 1.75
D	TWW-w	MT20	2.0	4.0
E	TTWW-m	MT20	5.0	6.0 1.75 1.75
H	TMBMVW1+pm	MT20	6.0	9.0 7.50 2.75
I	BMWW-l	MT20	4.0	6.0
J	BMWWW-l	MT20	4.0	9.0
K	BMWW-l	MT20	4.0	6.0
L	TMBMVW1+pm	MT20	6.0	9.0 7.50 2.75

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG
L	1198	0	1198	0	0	5-8	5-8	5-8	5-8
H	1193	0	1193	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS		LIVE		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	VERT.	LOAD	LC1	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN
L	843	574	0	0	0	0	0	0	0	0	0	269	0	0	0
H	840	572	0	0	0	0	0	0	0	0	0	268	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.61 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED		FACTORED		WEBS		MAX. FACTORED		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1	MAX	OSI (LC)	MEMB.	FORCE (LBS)	MAX	OSI (LC)	MEMB.	FORCE (LBS)
FR-TO		FROM TO				FR-TO				FR-TO	
A-B	0 38	-91.8	-91.8	0.14 (1)	10.00	K-C	-80 30	0.01 (1)			
B-C	-1199 0	-91.8	-91.8	0.15 (1)	5.64	C-J	0 896	0.22 (1)			
C-M	-1738 0	-91.8	-91.8	0.38 (1)	4.61	J-D	-612 0	0.10 (1)			
M-D	-1738 0	-91.8	-91.8	0.36 (1)	4.61	J-E	0 902	0.22 (1)			
D-N	-1738 0	-91.8	-91.8	0.36 (1)	4.61	I-E	-82 29	0.01 (1)			
N-E	-1738 0	-91.8	-91.8	0.36 (1)	4.61	B-K	0 960	0.24 (1)			
E-F	-1192 0	-91.8	-91.8	0.15 (1)	5.65	I-F	0 955	0.24 (1)			
F-G	0 38	-91.8	-91.8	0.14 (1)	10.00						
L-B	-1200 0	0.0	0.0	0.13 (1)	7.28						
H-F	-1195 0	0.0	0.0	0.13 (1)	7.28						
L-K	0 0	-18.5	-18.5	0.06 (4)	10.00						
K-O	0 927	-18.5	-18.5	0.24 (1)	10.00						
O-J	0 927	-18.5	-18.5	0.24 (1)	10.00						
J-P	0 921	-18.5	-18.5	0.25 (1)	10.00						
P-I	0 921	-18.5	-18.5	0.25 (1)	10.00						
I-H	0 0	-18.5	-18.5	0.08 (4)	10.00						

FACTORED CONCENTRATED LOADS (LBS)		LOC.		MAX.		FACE		DIR.		TYPE		HEEL		CONN.	
JT	LOC.	LC1	MAX.	MAX+	MAX-	FACE	MAX+	DIR.	MAX-	TYPE	MAX	HEEL	MAX	CONN.	MAX
C	1-9-10	-18	-18	---	---	FRONT	VERT	DEAD	---	---	---	---	---	C1	---
C	1-9-10	-90	-90	---	---	BACK	VERT	TOTAL	---	---	---	---	---	C1	---
C	1-9-10	-84	-84	---	---	FRONT	VERT	SNOW	---	---	---	---	---	C1	---
D	5-7-10	-83	-83	---	---	BACK	VERT	TOTAL	---	---	---	---	---	C1	---
E	9-8-6	-16	-16	---	---	FRONT	VERT	DEAD	---	---	---	---	---	C1	---
E	9-8-6	-90	-90	---	---	BACK	VERT	TOTAL	---	---	---	---	---	C1	---
E	9-8-6	-84	-84	---	---	FRONT	VERT	SNOW	---	---	---	---	---	C1	---
I	9-7-10	-48	-48	---	---	BACK	VERT	TOTAL	---	---	---	---	---	C1	---
J	5-7-10	-48	-48	---	---	BACK	VERT	TOTAL	---	---	---	---	---	C1	---
K	1-10-6	-48	-48	---	---	BACK	VERT	TOTAL	---	---	---	---	---	C1	---
M	3-7-10	-83	-83	---	---	BACK	VERT	TOTAL	---	---	---	---	---	C1	---
N	7-7-10	-83	-83	---	---	BACK	VERT	TOTAL	---	---	---	---	---	C1	---
O	3-7-10	-48	-48	---	---	BACK	VERT	TOTAL	---	---	---	---	---	C1	---
P	7-7-10	-48	-48	---	---	BACK	VERT	TOTAL	---	---	---	---	---	C1	---

CONNECTION REQUIREMENTS
 1) C1: A SUITABLE HANGER MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA
 *** SPECIAL LOADS ANALYSIS ***
 GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
 LOADS WERE DERIVED FROM USER INPUT
 NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
 ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
 OVERHANG NOT TO BE ALTERED OR CUT OFF.

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.38")
 CALCULATED VERT. DEFL. (LL) = L/999 (0.03")
 ALLOWABLE DEFL. (TL) = L/360 (0.38")
 CALCULATED VERT. DEFL. (TL) = L/999 (0.06")

CSI: TC=0.38/1.00 (C-D:1) . BC=0.25/1.00 (I-J:1) . WB=0.24/1.00 (B-K:1) . SS=0.24/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES		PLATE GRIP (DRY)		SHEAR		SECTION	
(PS)	(PL)	(PS)	(PL)	(PS)	(PL)	(PS)	(PL)
MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN
MT20	818	354	1697	788	1987	1656	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.85 (E) (INPUT = 0.90)
 JSI METAL = 0.28 (C) (INPUT = 1.00)

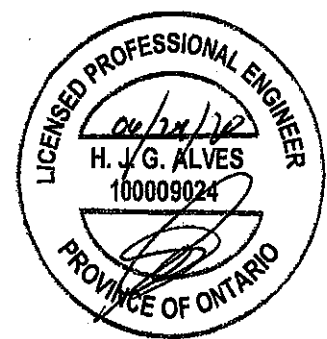

Structural component only
 DWG# T-2006917

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408039	T45	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 28 2019 Mittek Industries, Inc. Fri Apr 24 14:59:40 2020 Page 1
 ID:DMCubINVR6TstFoe31v6l zns1l-csMtd qogwRHVJP2wAkN6tdQMmdqV8?RayEXzNUPX
 1-3-8 0-0 5-10-7 5-10-7 7-11-3 3-10-2 11-9-8 5-9-10 17-7-0 5-9-10 23-4-10 5-10-14 29-3-9 35-2-0 35-5-8
 Scale = 1:57.6

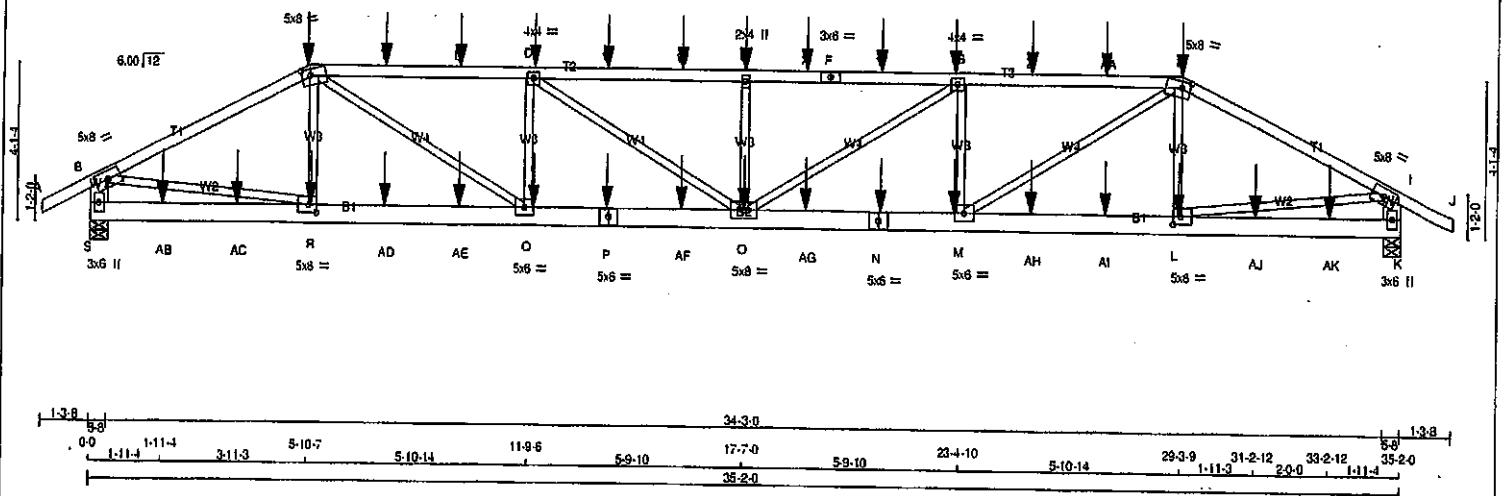

LUMBER	N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF		
C - F	2x4 DRY	No.2	SPF		
F - H	2x4 DRY	No.2	SPF		
H - J	2x4 DRY	No.2	SPF		
S - B	2x6 DRY	No.2	SPF		
K - I	2x6 DRY	No.2	SPF		
S - P	2x6 DRY	No.2	SPF		
P - N	2x6 DRY	No.2	SPF		
N - K	2x6 DRY	No.2	SPF		
ALL WEBS EXCEPT	2x3 DRY	No.2	SPF		

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122'X3') SPIRAL NAILS		
A-C	12	SIDE(61.0)
C-F	12	SIDE(61.0)
F-H	12	SIDE(61.0)
H-J	12	SIDE(61.0)
S-B	2	TOP
K-I	2	TOP
BOTTOM CHORDS: (0.122'X3') SPIRAL NAILS		
S-P	2	SIDE(183.1)
P-N	2	SIDE(183.1)
N-K	2	SIDE(183.1)
WEBS: (0.122'X3') SPIRAL NAILS		
2x3	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UPLIFT	IN-SX
S	3341 0	3341 0	0	5-8
K	3341 0	3341 0	0	5-8

UNFACTORED REACTIONS

1ST LOSE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	2363	1549 0	0 0	0 0	0 0	814 0	0 0
K	2363	1549 0	0 0	0 0	0 0	814 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.86 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)
FR-TO				FR-TO	
A-B	0 28	-91.8 -91.8 0.07 (1)	10.00	R-C	-386 31
B-C	-5091 0	-91.8 -91.8 0.52 (1)	3.86	C-Q	0 3088
C-T	-7153 0	-91.8 -91.8 0.75 (1)	3.08	Q-D	-1482 0
T-U	-7153 0	-91.8 -91.8 0.75 (1)	3.08	D-O	0 917
U-D	-7153 0	-91.8 -91.8 0.75 (1)	3.08	O-E	-820 0
D-V	-7925 0	-91.8 -91.8 0.82 (1)	2.86	O-G	0 917
V-W	-7925 0	-91.8 -91.8 0.82 (1)	2.86	M-G	-1482 0
W-E	-7925 0	-91.8 -91.8 0.82 (1)	2.86	M-H	0 3088
E-X	-7925 0	-91.8 -91.8 0.82 (1)	2.86	L-H	-386 31
X-F	-7925 0	-91.8 -91.8 0.82 (1)	2.86	B-R	0 4589
F-Y	-7925 0	-91.8 -91.8 0.82 (1)	2.86	L-I	0 4589
Y-G	-7925 0	-91.8 -91.8 0.82 (1)	2.86		
G-Z	-7153 0	-91.8 -91.8 0.75 (1)	3.08		
Z-AA	-7153 0	-91.8 -91.8 0.75 (1)	3.08		
AA-H	-7153 0	-91.8 -91.8 0.75 (1)	3.08		
H-I	-5091 0	-91.8 -91.8 0.52 (1)	3.86		
I-J	0 28	-91.8 -91.8 0.07 (1)	10.00		
S-B	-3266 0	0.0 0.0 0.11 (1)	7.68		
K-I	-3266 0	0.0 0.0 0.11 (1)	7.68		

S-AB	0 0	-18.5 -18.5 0.06 (4)	10.00
AB-AC	0 0	-18.5 -18.5 0.06 (4)	10.00
AC-R	0 0	-18.5 -18.5 0.06 (4)	10.00
R-AD	0 4540	-18.5 -18.5 0.34 (1)	10.00
AD-AE	0 4540	-18.5 -18.5 0.34 (1)	10.00
AE-O	0 4540	-18.5 -18.5 0.34 (1)	10.00
O-P	0 7153	-18.5 -18.5 0.53 (1)	10.00
P-AF	0 7153	-18.5 -18.5 0.53 (1)	10.00
AF-O	0 7153	-18.5 -18.5 0.53 (1)	10.00
O-AG	0 7153	-18.5 -18.5 0.53 (1)	10.00
AG-N	0 7153	-18.5 -18.5 0.53 (1)	10.00
N-M	0 7153	-18.5 -18.5 0.53 (1)	10.00
M-AH	0 4540	-18.5 -18.5 0.34 (1)	10.00
AH-AI	0 4540	-18.5 -18.5 0.34 (1)	10.00
AI-L	0 4540	-18.5 -18.5 0.34 (1)	10.00
L-AJ	0 0	-18.5 -18.5 0.06 (4)	10.00
AJ-AK	0 0	-18.5 -18.5 0.06 (4)	10.00
AK-K	0 0	-18.5 -18.5 0.06 (4)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-7	-447	-447	---	BACK	VERT	TOTAL	---	C1
D	11-11-3	-110	-110	---	BACK	VERT	TOTAL	---	C1

TOTAL WEIGHT = 2 X 154 = 309 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.8	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17')
 CALCULATED VERT. DEFL. (LL) = L/999 (0.25')
 ALLOWABLE DEFL. (TL) = L/360 (1.17')
 CALCULATED VERT. DEFL. (TL) = L/889 (0.47')

CSI: TC=0.82/1.00 (E-G:1), BC=0.53/1.00 (M-O:1), WB=0.57/1.00 (I-L:1), SS=0.20/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	818	354	1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (C) (INPUT = 0.90)
 JSI METAL = 0.69 (P) (INPUT = 1.00)



Structural component only
 DWG# T-2006927

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408039	T45	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 14:59:40 2020 Page 2

ID:DMCubINVR6TstFoe31v6I zns11-csMtd oqgwRHBVJP2wAkN6ldQMmdgV87RavEXzNUPX

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-1	MT20	5.0	8.0		
C	TTWW-m	MT20	5.0	8.0	2.00	2.75
D	TMWV-1	MT20	4.0	4.0		
E	TMW+w	MT20	2.0	4.0		
F	TS-1	MT20	3.0	6.0		
G	TMWV-1	MT20	4.0	4.0		
H	TTWW-m	MT20	5.0	8.0	2.00	2.75
I	TMWV-1	MT20	5.0	8.0		
K	BMV1+p	MT20	3.0	6.0		
L	BMWV-1	MT20	5.0	6.0	2.50	2.50
M	BMWV-1	MT20	5.0	6.0		
N	BS-1	MT20	5.0	6.0		
O	BMWV-1	MT20	5.0	6.0		
P	BS-1	MT20	5.0	6.0		
Q	BMWV-1	MT20	5.0	6.0		
R	BMWV-1	MT20	5.0	6.0	2.50	2.50
S	BMV1+p	MT20	3.0	6.0		

FACTORED CONCENTRATED LOADS (LBS)


JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	17-7-0	-110	-110	---	BACK	VERT	TOTAL	---	C1
G	23-2-13	-110	-110	---	BACK	VERT	TOTAL	---	C1
H	29-3-9	-447	-447	---	BACK	VERT	TOTAL	---	C1
L	29-2-13	-26	-26	---	BACK	VERT	TOTAL	---	C1
M	23-2-13	-26	-26	---	BACK	VERT	TOTAL	---	C1
N	21-2-13	-26	-26	---	BACK	VERT	TOTAL	---	C1
O	17-7-0	-26	-26	---	BACK	VERT	TOTAL	---	C1
P	13-11-3	-26	-26	---	BACK	VERT	TOTAL	---	C1
Q	11-11-3	-26	-26	---	BACK	VERT	TOTAL	---	C1
R	5-11-3	-26	-26	---	BACK	VERT	TOTAL	---	C1
T	7-11-3	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	9-11-3	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	13-11-3	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	15-11-3	-110	-110	---	BACK	VERT	TOTAL	---	C1
X	19-2-13	-110	-110	---	BACK	VERT	TOTAL	---	C1
Y	21-2-13	-110	-110	---	BACK	VERT	TOTAL	---	C1
Z	25-2-13	-110	-110	---	BACK	VERT	TOTAL	---	C1
AA	27-2-13	-110	-110	---	BACK	VERT	TOTAL	---	C1
AB	1-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AC	3-11-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AD	7-11-3	-26	-26	---	BACK	VERT	TOTAL	---	C1
AE	9-11-3	-26	-26	---	BACK	VERT	TOTAL	---	C1
AF	15-11-3	-26	-26	---	BACK	VERT	TOTAL	---	C1
AG	19-2-13	-26	-26	---	BACK	VERT	TOTAL	---	C1
AH	25-2-13	-26	-26	---	BACK	VERT	TOTAL	---	C1
AI	27-2-13	-26	-26	---	BACK	VERT	TOTAL	---	C1
AJ	31-2-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AK	33-2-12	-26	-26	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

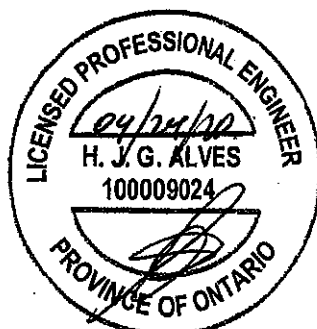

JOB NAME 408039	TRUSS NAME T46	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 24 14:59:41 2020 Page 1	
ID:DMCubINVR6TsiFoe31v6l_zns1l-53wFqKQRDZ8ofucczhwKQmxqgKMDIHESJWmzzNUPW				20-9-7 6-8-2 27-3-9 31-1-8 35-2-0 38-5-8	
1-3-8 0-0 4-0-8 4-0-8 3-10-0 7-10-7 9-6-2 14-4-9 6-1-11 6-8-2 27-3-9 31-1-8 35-2-0 38-5-8				Scale = 1:57.6	

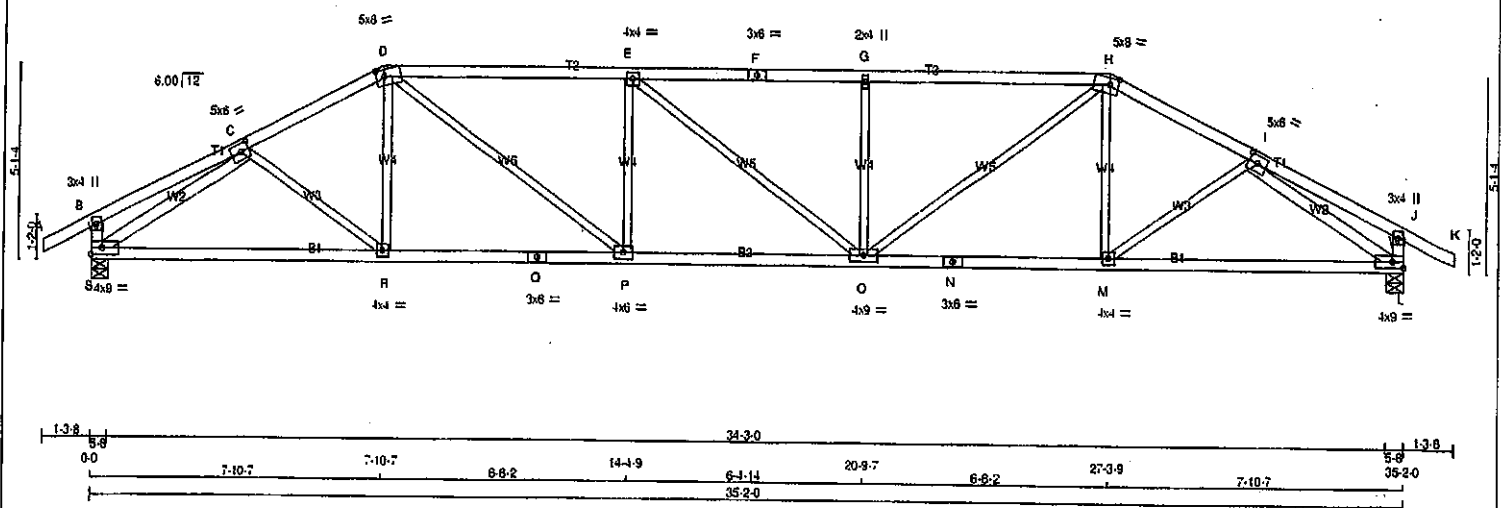

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
S - C	2x4	DRY	No.2
I - L	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMV+p	MT20	3.0	4.0	
C TMWW-t	MT20	5.0	6.0	2.50 2.75
D TTWW-m	MT20	5.0	8.0	2.25 2.75
E TMWW-t	MT20	4.0	4.0	
F TS-t	MT20	3.0	6.0	
G TMW+u	MT20	2.0	4.0	
H TTWW-m	MT20	5.0	8.0	2.25 2.75
I TMWW-t	MT20	5.0	6.0	2.50 2.75
J TMV+p	MT20	3.0	4.0	
L BMVW-t	MT20	4.0	9.0	Edge
M BMWW-t	MT20	4.0	4.0	
N BS-t	MT20	3.0	6.0	
O BMWWW-t	MT20	4.0	9.0	
P BMWW-t	MT20	4.0	6.0	
Q BS-t	MT20	3.0	6.0	
R BMWW-t	MT20	4.0	4.0	
S BMVW-t	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG
S	2083	0	2083	0	0	5-8	5-8		
L	2083	0	2083	0	0	5-8	5-8		

UNFACTORED REACTIONS

1ST LOASE		MAX. MIN. COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	DEAD	SOIL
S	1457	969	0	0	0	0	0	488	0
L	1457	969	0	0	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.94 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FACTORED	VERT. LOAD	CSF (LC)	MEMB.	MAX. FACTORED	VERT. LOAD	CSF (LC)
FR-TO				FR-TO			
A-B	0 28	-91.8	-91.8 0.12 (1)	C-R	0 93	0.03 (4)	
B-C	0 18	-91.8	-91.8 0.20 (1)	R-D	0 121	0.04 (4)	
C-D	-2799 0	-91.8	-91.8 0.32 (1)	D-P	0 1288	0.29 (1)	
D-E	-3510 0	-91.8	-91.8 0.95 (1)	P-E	-844 0	0.25 (1)	
E-F	-3508 0	-91.8	-91.8 0.93 (1)	E-O	-2 0	0.00 (1)	
F-G	-3508 0	-91.8	-91.8 0.93 (1)	O-G	-843 0	0.25 (1)	
G-H	-3508 0	-91.8	-91.8 0.94 (1)	O-H	0 1267	0.29 (1)	
H-I	-2799 0	-91.8	-91.8 0.32 (1)	M-H	0 121	0.04 (4)	
I-J	0 18	-91.8	-91.8 0.20 (1)	M-I	0 93	0.03 (4)	
J-K	0 28	-91.8	-91.8 0.12 (1)	S-C	-2973 0	0.83 (1)	
S-B	-270 0	0.0	0.0 0.03 (1)	I-L	-2974 0	0.83 (1)	
L-J	-270 0	0.0	0.0 0.03 (1)				
S-R	0 2417	-18.5	-18.5 0.53 (1)				
R-Q	0 2489	-18.5	-18.5 0.54 (1)				
Q-P	0 2489	-18.5	-18.5 0.54 (1)				
P-O	0 3510	-18.5	-18.5 0.84 (1)				
O-N	0 2489	-18.5	-18.5 0.54 (1)				
N-M	0 2489	-18.5	-18.5 0.54 (1)				
M-L	0 2417	-18.5	-18.5 0.53 (1)				

TOTAL WEIGHT = 2 X 139 = 278 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17')
CALCULATED VERT. DEFL. (LL) = L/999 (0.21')
ALLOWABLE DEFL. (TL) = L/360 (1.17')
CALCULATED VERT. DEFL. (TL) = L/999 (0.41')

CSI: TC=0.95/1.00 (D-E:1), BC=0.64/1.00 (O-P:1),
WB=0.83/1.00 (H-L:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (L) (INPUT = 0.90)
JSI METAL = 0.77 (N) (INPUT = 1.00)

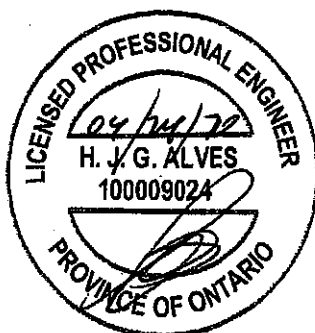

Structural component only
DWG# T-2006928

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408039	T47	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 14:59:42 2020 Page 1
ID:DMCubINVR6TsiFoe31v6l_zns11-ZFUD1fs3CXh7QpTqALCCSxywHE3g5jIQS33IPzNUPV

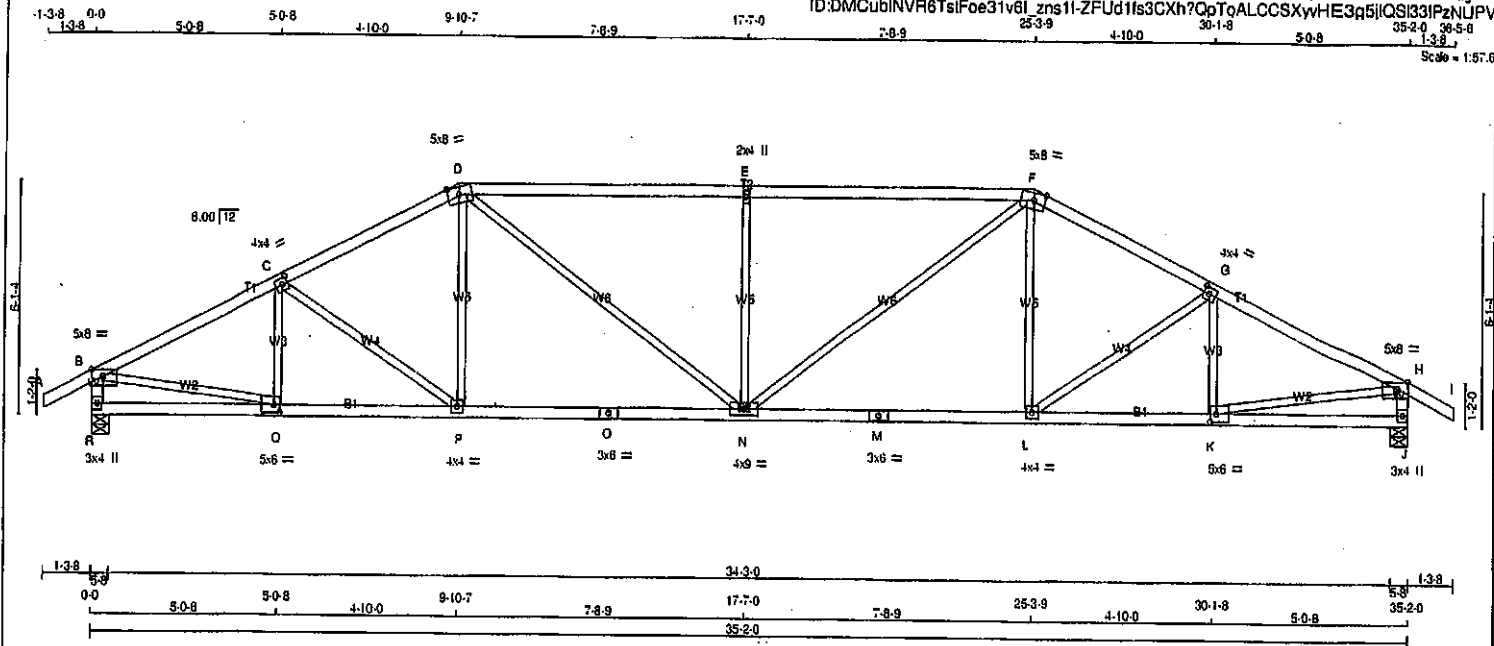

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - B	2x4	DRY	No.2
B - H	2x4	DRY	No.2
H - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)			
JT	TYPE	PLATES	W LEN Y X
B	TMVW-p	MT20	5.0 8.0 Edge 3.50
C	TMWW-t	MT20	4.0 4.0 2.00 1.75
D	TTWW-m	MT20	5.0 8.0 2.25 3.75
E	TMW-w	MT20	2.0 4.0
F	TTWW-m	MT20	5.0 8.0 2.25 3.75
G	TMWW-t	MT20	4.0 4.0 2.00 1.75
H	TMVW-p	MT20	5.0 8.0 Edge 3.50
J	BMV1+p	MT20	3.0 4.0
K	BMWW-t	MT20	5.0 8.0 2.50 2.00
L	BMWW-t	MT20	4.0 4.0
M	BS-t	MT20	3.0 6.0
N	BMWW-t	MT20	4.0 9.0
O	BS-t	MT20	3.0 6.0
P	BMWW-t	MT20	4.0 4.0
Q	BMWW-t	MT20	5.0 8.0 2.50 2.00
R	BMV1+p	MT20	3.0 4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
	FACTORED	MAXIMUM FACTORED	INPUT
	GROSS REACTION	GROSS REACTION	BRG
JT	VERT	DOWN	IN-SX
R	2063 0	2063 0	5-8
J	2063 0	2063 0	5-8

UNFACTORED REACTIONS			
1ST LCASE	MAX. MIN. COMPONENT REACTIONS		
JT	COMBINED	SNOW	LIVE
R	1457 989 0	0 0	0 0
J	1457 989 0	0 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.78 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)
FR-TO			
A-B	0 28	-91.8 -91.8 0.12 (1)	10.00
B-C	-2834 0	-91.8 -91.8 0.39 (1)	3.81
C-D	-2888 0	-91.8 -91.8 0.37 (1)	3.91
D-E	-3081 0	-91.8 -91.8 0.97 (1)	2.78
E-F	-3061 0	-91.8 -91.8 0.97 (1)	2.78
F-G	-2888 0	-91.8 -91.8 0.37 (1)	3.81
G-H	-2834 0	-91.8 -91.8 0.39 (1)	3.81
H-I	0 28	-91.8 -91.8 0.12 (1)	10.00
I-B	-2018 0	0.0 0.0 0.20 (1)	5.94
J-H	-2018 0	0.0 0.0 0.20 (1)	5.94
R-Q	0 0	-18.5 -18.5 0.10 (4)	10.00
Q-P	0 2654	-18.5 -18.5 0.51 (1)	10.00
P-O	0 2386	-18.5 -18.5 0.49 (1)	10.00
O-N	0 2386	-18.5 -18.5 0.49 (1)	10.00
N-M	0 2386	-18.5 -18.5 0.49 (1)	10.00
M-L	0 2386	-18.5 -18.5 0.49 (1)	10.00
L-K	0 2554	-18.5 -18.5 0.51 (1)	10.00
K-J	0 0	-18.5 -18.5 0.10 (4)	10.00

TOTAL WEIGHT = 2 X 139 = 277 lb (M/F)

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF
SPACING	= 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00.12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.17")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.34")

CSI: TC=0.97/1.00 (D-E:1), BC=0.51/1.00 (K-L:1), WB=0.58/1.00 (H-K:1), SSI=0.34/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES			
PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN MAX MIN
MT20	618	354	1687 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.87 (D) (INPUT = 0.90)

JSI METAL = 0.82 (M) (INPUT = 1.00)

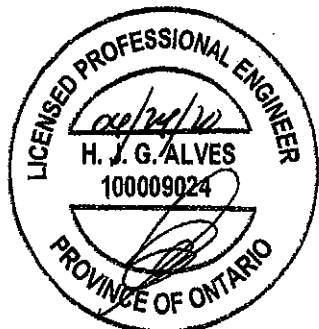

Structural component only
DWG# T-2006929

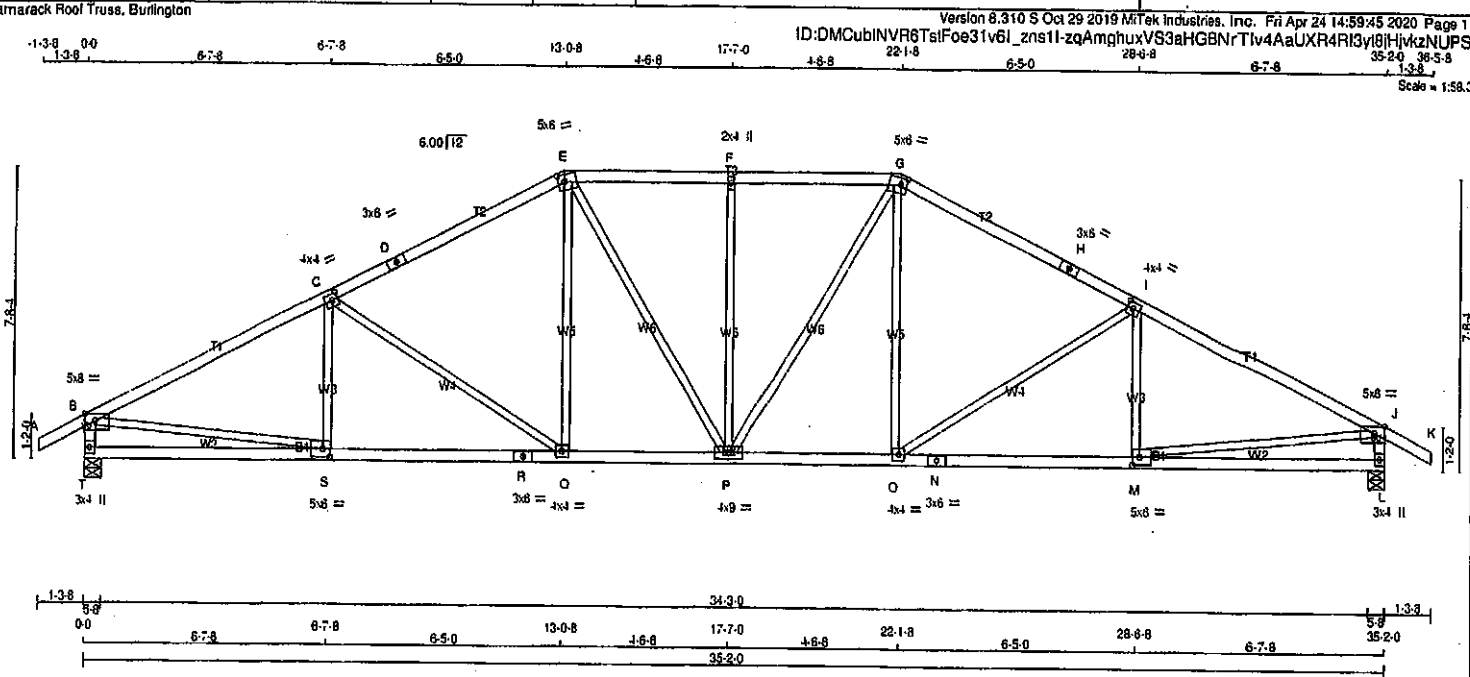

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - H	2x4	DRY	No.2	SPF
H - K	2x4	DRY	No.2	SPF
T - B	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
T - R	2x4	DRY	No.2	SPF
R - N	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TMWW-I	MT20	4.0	4.0	2.00	1.75
D	TS-I	MT20	3.0	8.0		
E	TTWW-m	MT20	5.0	8.0	2.25	2.00
F	TMW-w	MT20	2.0	4.0		
G	TTWW-m	MT20	5.0	8.0	2.25	2.00
H	TS-I	MT20	3.0	8.0		
I	TMWW-I	MT20	4.0	4.0	2.00	1.75
J	TMVW-p	MT20	5.0	8.0	Edge	3.50
L	BMV1+p	MT20	3.0	4.0		
M	BMWW-I	MT20	5.0	8.0	2.50	2.25
N	BS-I	MT20	3.0	8.0		
O	BMWW-I	MT20	4.0	4.0		
P	BMWWW-I	MT20	4.0	9.0		
Q	BMWW-I	MT20	4.0	4.0		
R	BS-I	MT20	3.0	8.0		
S	BMWW-I	MT20	5.0	8.0	2.50	2.25
T	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	UP		
T	2063	0	2063	0	5-8	5-8
L	2063	0	2063	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM. LIVE	WIND			
T	1457	989	0	0	0	0	0
L	1457	989	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.41 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)
FR-TO				
A-B	0	28	-81.8	-91.8
B-C	-2904	0	-91.8	-91.8
C-D	-2443	0	-91.8	-91.8
D-E	-2443	0	-91.8	-91.8
E-F	-2338	0	-91.8	-91.8
F-G	-2338	0	-91.8	-91.8
G-H	-2443	0	-91.8	-91.8
H-I	-2443	0	-91.8	-91.8
I-J	-2904	0	-91.8	-91.8
J-K	0	28	-91.8	-91.8
T-B	-2011	0	0.0	0.0
L-J	-2011	0	0.0	0.0
T-S	0	0	-18.5	-18.5
S-R	0	2625	-18.5	-18.5
R-Q	0	2625	-18.5	-18.5
Q-P	0	2161	-18.5	-18.5
P-O	0	2161	-18.5	-18.5
O-N	0	2625	-18.5	-18.5
N-M	0	2625	-18.5	-18.5
M-L	0	0	-18.5	-18.5

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2018, CBC 2012, ABC 2018
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.27")

CSI: TC=0.72:1.00 (I-J:1), BC=0.50:1.00 (M-O:1), WB=0.69:1.00 (I-O:1), SS=0.28:1.00 (J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.89 (M) (INPUT = 0.90)
JSI METAL= 0.75 (N) (INPUT = 1.00)




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408039	T50	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		Version 8.310 S Oct 29 2019 MTek Industries, Inc. Fri Apr 24 14:59:48 2020 Page 2			
		ID:DMCubINVR6TslF0g31v6l zns1I-R0k81vZGmBRvQmZPBG8dN7kmrNd1T10NN1HRAzNUPR			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVV-p	MT20	5.0	8.0	2.00 2.75
C, D, J					
C	TMWW-t	MT20	4.0	4.0	2.00 1.75
E	TS-t	MT20	3.0	6.0	
F	TTW+p	MT20	4.0	8.0	Edge
G	TMWW-t	MT20	5.0	6.0	
H	TTWW-m	MT20	5.0	8.0	
I	TTW-m	MT20	5.0	8.0	2.00 4.00
K	TMVV-p	MT20	4.0	9.0	1.00 4.75
M	BMV1+p	MT20	3.0	6.0	
N	BMWW-t	MT20	5.0	8.0	2.50 2.75
O	BMWW-t	MT20	7.0	8.0	4.25 2.50
P, T, U					
P	BMWW-t	MT20	5.0	6.0	
Q	BS-t	MT20	5.0	6.0	
R	BMWW-t	MT20	5.0	8.0	
S	BS-t	MT20	5.0	8.0	
V	BMV1+p	MT20	3.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.


CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

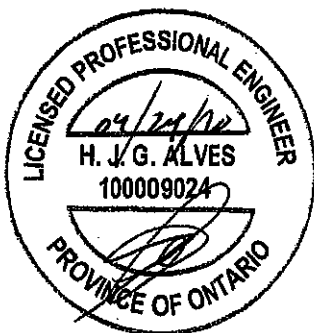

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408039	T51	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 5 Oct 29 2019 MTek Industries, Inc. Fri Apr 24 14:59:47 2020 Page 1
 ID:DMCubINVR6TstF0931v6I_znsfI-vDHWSNWB13KHxAlzuoN9bgi6Fim7a9c1mqdzNUPO
 Scale: 1/4"=1'

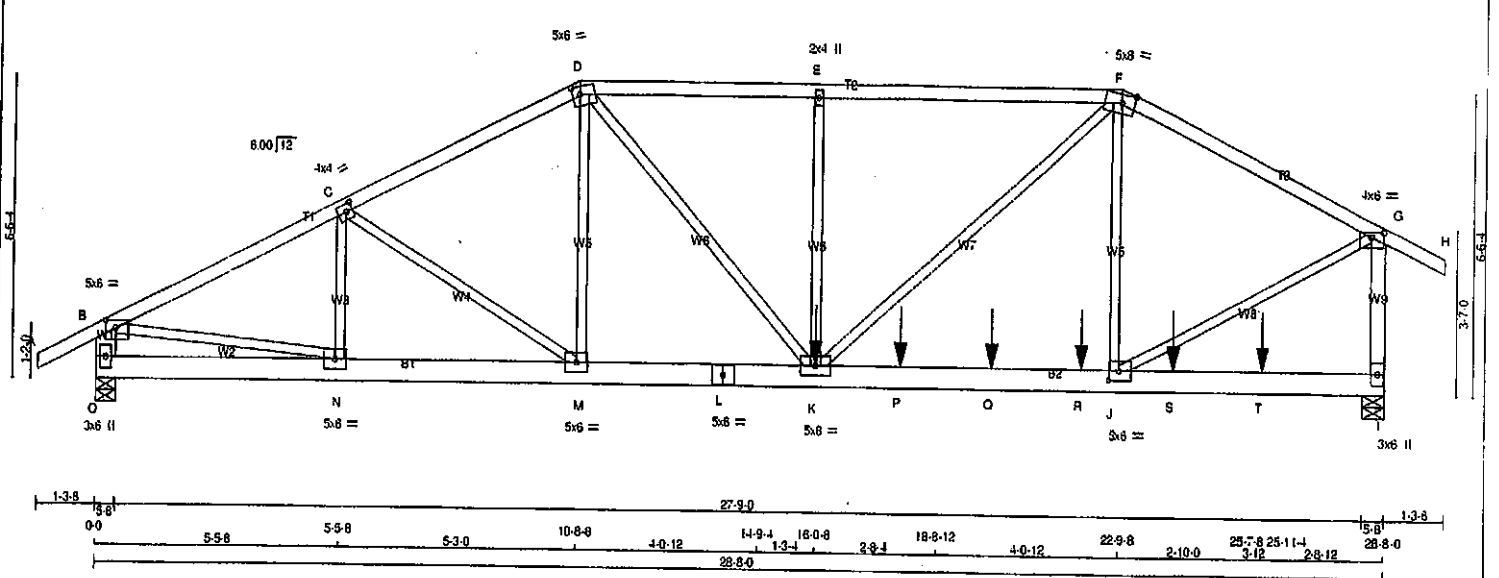

LUMBER
 N. L. G. A. RULES
 CHORDS SIZE LUMBER DESCR.
 A - D 2x4 DRY No.2 SPF
 D - F 2x4 DRY No.2 SPF
 F - H 2x4 DRY No.2 SPF
 O - B 2x6 DRY No.2 SPF
 I - G 2x4 DRY No.2 SPF
 O - L 2x6 DRY No.2 SPF
 L - I 2x6 DRY No.2 SPF
 ALL WEBS 2x3 DRY No.2 SPF
 EXCEPT
 DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										TOTAL WEIGHT = 2 X 138 = 277 lb	
BEARINGS											
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	IN-SX	IN-SX	IN-SX	IN-SX	IN-SX	IN-SX	IN-SX
O	2880	0	2880	0	0	5-8	5-8	5-8	5-8	5-8	5-8
I	4124	0	4124	0	0	5-8	5-8	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS									
JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	SOIL
O	2016	1360	0	0	0	0	0	0	0
I	2905	1972	0	0	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, I.

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.93 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS										WEBS									
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO										FR-TO									
A-B	0	28	-91.8	-91.8	0.07 (1)	10.00	N-C	-490	0	0.08 (1)									
B-C	-4279	0	-91.8	-91.8	0.35 (1)	4.32	C-M	-120	0	0.04 (1)									
C-D	-4218	0	-91.8	-91.8	0.34 (1)	4.35	M-D	0	171	0.02 (4)									
D-E	-4919	0	-91.8	-91.8	0.45 (1)	3.93	D-K	0	1782	0.22 (1)									
E-F	-4919	0	-91.8	-91.8	0.52 (1)	3.93	J-F	-333	0	0.11 (1)									
F-G	-3705	0	-91.8	-91.8	0.43 (1)	4.49	J-G	0	3754	0.48 (1)									
G-H	0	28	-91.8	-91.8	0.07 (1)	10.00	B-N	0	3887	0.48 (1)									
O-B	-2792	0	0.0	0.0	0.10 (1)	7.81	K-E	-873	0	0.22 (1)									
I-G	-3822	0	0.0	0.0	0.39 (1)	6.03	K-F	0	2180	0.27 (1)									
O-N	0	0	-18.5	-18.5	0.05 (1)	10.00													
N-M	0	3848	-18.5	-18.5	0.29 (1)	10.00													
M-L	0	3750	-18.5	-18.5	0.29 (1)	10.00													
L-K	0	3750	-18.5	-18.5	0.29 (1)	10.00													
P-Q	0	3305	-18.5	-18.5	0.54 (1)	10.00													
Q-R	0	3305	-18.5	-18.5	0.54 (1)	10.00													
R-J	0	3305	-18.5	-18.5	0.54 (1)	10.00													
J-S	0	0	-18.5	-18.5	0.33 (1)	10.00													
S-T	0	0	-18.5	-18.5	0.33 (1)	10.00													
T-I	0	0	-18.5	-18.5	0.33 (1)	10.00													

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
K	16-0-8	-1744	-1744	---	FRONT	VERT	TOTAL	---	C1
P	17-11-4	-305	-305	---	FRONT	VERT	TOTAL	---	C1
O	19-11-4	-305	-305	---	FRONT	VERT	TOTAL	---	C1
Q	21-11-4	-305	-305	---	FRONT	VERT	TOTAL	---	C1
S	23-11-4	-305	-305	---	FRONT	VERT	TOTAL	---	C1
T	25-11-4	-609	-609	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS
 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA
 SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF


SPACING = 24.0 IN. C/C
 LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.96")
 CALCULATED VERT. DEFL. (LL) = L/999 (0.10")
 ALLOWABLE DEFL. (TL) = L/360 (0.96")
 CALCULATED VERT. DEFL. (TL) = L/999 (0.18")
 CSI: TC=0.52/1.00 (E-F:1), BC=0.54/1.00 (J-K:1), WB=0.48/1.00 (B-N:1), SS=0.24/1.00 (I-J:1)
 DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00
 COMPANION LIVE LOAD FACTOR = 1.00
 AUTOSOLVE HEELS OFF
 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
 NAIL VALUES
 PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1656
 PLATE PLACEMENT TOL. = 0.250 inches
 PLATE ROTATION TOL. = 5.0 Deg.
 JSI GRIP = 0.90 (D) (INPUT = 0.90)
 JSI METAL = 0.48 (N) (INPUT = 1.00)

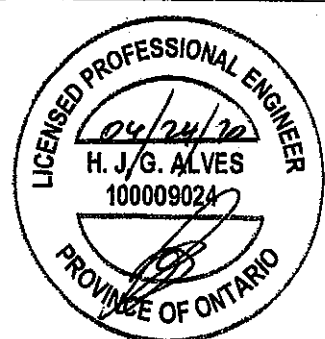

Structural component only
 DWG# T-2006933

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408039	T51	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 24 14:59:47 2020 Page 2
ID:DMCubINVR6TslFoe31v6I zns1l-vDHW5NwB13KHxalUzuoN9bg16Film?a9c1mqzdzNUPO

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	2.00	2.75
C	TMWW-l	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	5.0	6.0	2.00	2.00
E	TMW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	8.0	2.25	3.25
G	TMVW-p	MT20	4.0	6.0	1.25	3.00
I	BMV1+p	MT20	3.0	6.0		
J	BMWW-l	MT20	5.0	6.0	2.50	2.75
K	BMWWW-l	MT20	5.0	8.0		
L	BS-l	MT20	5.0	6.0		
M	BMWW-l	MT20	5.0	6.0		
N	BMWW-l	MT20	5.0	6.0		
O	BMV1+p	MT20	3.0	6.0		




Structural component only
DWG# T-2006933 *ML*

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408039	T52	1	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Fri Apr 24 14:59:48 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-NPrvIwpoNS88kwyWcJcioC1ee7ZVL0JrhWOW3zNUPP

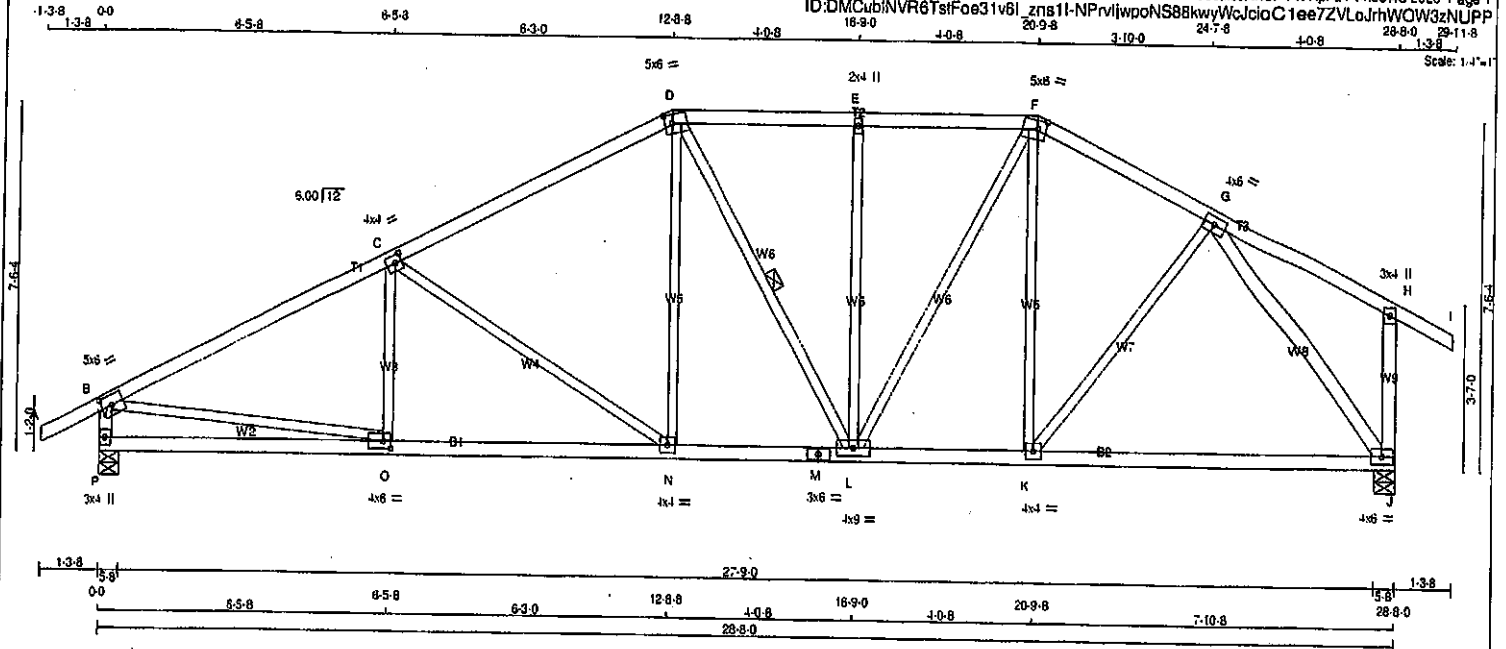

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DRY
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
P - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
P - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT	G - J	2x4	DRY
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMVW-1	MT20	5.0	8.0 2.50 2.75
C	TMVW-1	MT20	4.0	4.0 2.00 1.75
D	TTVW-m	MT20	5.0	8.0 2.25 2.00
E	TMVW-w	MT20	2.0	4.0
F	TTVW-m	MT20	5.0	8.0 2.25 2.00
G	TMVW-1	MT20	4.0	8.0
H	TMVW-p	MT20	3.0	4.0
J	BMVW-1	MT20	4.0	8.0
K	BMVW-1	MT20	4.0	4.0
L	BMVW-1	MT20	4.0	9.0
M	BS-1	MT20	3.0	8.0
N	BMVW-1	MT20	4.0	4.0
O	BMVW-1	MT20	3.0	6.0 2.00 2.00
P	BMV1-p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	
P	1705	0	1705	0	5-8
J	1705	0	1705	0	5-8

UNFACTORED REACTIONS							
JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
P	1203	803	0	0	0	0	0
J	1203	803	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.92 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-L

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING					
TOTAL LOAD CASES: (4)					
CHORDS			WEBS		
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		FR-TO	
A-B	0 28	-91.8 -91.8 0.12 (1)	10.00	O-C	-144 59
B-C	-2269 0	-91.8 -91.8 0.80 (1)	3.92	C-N	-604 0
C-D	-1765 0	-91.8 -91.8 0.53 (1)	4.42	N-D	0 435
D-E	-1544 0	-91.8 -91.8 0.21 (1)	5.10	D-L	-27 0
E-F	-1544 0	-91.8 -91.8 0.21 (1)	5.10	L-E	-449 0
F-G	-1438 0	-91.8 -91.8 0.29 (1)	5.25	E-F	0 570
G-H	0 19	-91.8 -91.8 0.23 (1)	10.00	K-F	-144 30
H-I	0 28	-91.8 -91.8 0.12 (1)	10.00	K-G	0 378
P-B	-1854 0	0.0 0.0 0.17 (1)	6.45	B-O	0 2075
J-H	-283 0	0.0 0.0 0.06 (1)	7.81	G-J	-1729 0
P-O	0 0	-18.5 -18.5 0.18 (4)	10.00		
O-N	0 2057	-18.5 -18.5 0.41 (1)	10.00		
N-M	0 1556	-18.5 -18.5 0.32 (1)	10.00		
M-L	0 1556	-18.5 -18.5 0.32 (1)	10.00		
L-K	0 1288	-18.5 -18.5 0.37 (4)	10.00		
K-J	0 1040	-18.5 -18.5 0.34 (4)	10.00		

TOTAL WEIGHT = 132 LB (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
OL = 8.0 PSF
BOT CH. LL = 0.0 PSF
OL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.96")
CALCULATED VERT. DEFL.(LL) = L/999 (0.98")
ALLOWABLE DEFL.(TL) = L/360 (0.96")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CSI: TC=0.80/1.00 (B-C:1), BC=0.41/1.00 (N-O:1), WB=0.93/1.00 (G-J:1), SS=0.25/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.80 (O) INPUT = 0.80
JSI METAL = 0.81 (B) INPUT = 1.00




Structural component only
DWG# T-2006934

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408039	T53	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Fri Apr 24 14:59:50 2020 Page 1

ID:DMCubINVR6TstFoe31v6I zns11-KozfjOy4K isO24Ke1L4nDJQSnJzMcbl ?UaxzNUPN

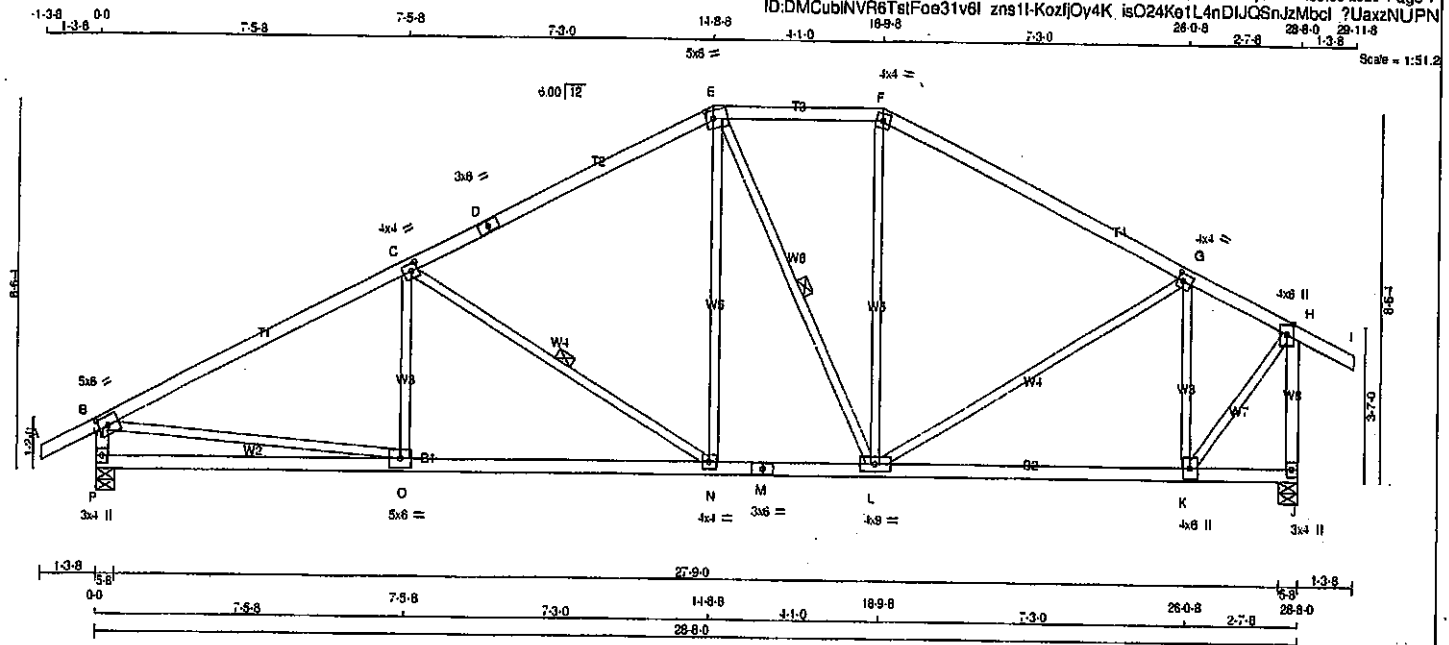

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
B - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
P - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
P - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-1	MT20	5.0	8.0	2.50 2.75
C	TMVW-1	MT20	4.0	4.0	2.00 1.75
D	TS-1	MT20	3.0	6.0	
E	TTWV-m	MT20	5.0	6.0	2.25 2.00
F	TTW-m	MT20	4.0	4.0	
G	TMVW-1	MT20	4.0	4.0	2.00 1.50
H	TMVW-p	MT20	4.0	8.0	Edge
J	BMV1-p	MT20	3.0	4.0	
K	BMVW-t	MT20	4.0	8.0	
L	BMVW-t	MT20	4.0	9.0	
M	BS-1	MT20	3.0	6.0	
N	BMVW-t	MT20	4.0	4.0	
O	BMVW-t	MT20	5.0	8.0	
P	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORZ	DOWN	HORZ	UPLIFT	N-SX	BRG	IN-SX
P	1705	0	0	1705	0	0	5-8	5-8	5-8
J	1705	0	0	1705	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS		LIVE		PERM.LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	WIND	PERM.LIVE	WIND	DEAD	SOIL	PERM.LIVE	WIND	DEAD	SOIL	PERM.LIVE	WIND	DEAD	SOIL
P	1203	803	0	0	0	0	0	0	0	0	0	400	0	0	0
J	1203	803	0	0	0	0	0	0	0	0	0	400	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.53 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, E-L

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 (LC)	MAX. CS1 (LC)	UNBRACED LENGTH	MEMB.	FORCE (LBS)	MAX. CS1 (LC)	UNBRACED LENGTH
FR-TO						FR-TO			
A-B	0 28	-91.8	-91.8	0.12 (1)	10.00	O-C	-80 99	0.03 (4)	10.00
B-C	-2259 0	-91.8	-91.8	0.84 (1)	3.53	C-N	-797 0	0.41 (1)	10.00
C-D	-1578 0	-91.8	-91.8	0.72 (1)	4.25	N-E	0 -514	0.12 (1)	10.00
D-E	-1578 0	-91.8	-91.8	0.72 (1)	4.25	E-L	-291 0	0.17 (1)	10.00
E-F	-1258 0	-91.8	-91.8	0.21 (1)	5.51	L-F	0 171	0.05 (4)	10.00
F-G	-1430 0	-91.8	-91.8	0.83 (1)	4.82	L-G	0 377	0.08 (1)	10.00
G-H	-987 0	-91.8	-91.8	0.48 (1)	5.62	K-G	-1048 0	0.37 (1)	10.00
H-I	0 28	-91.8	-91.8	0.12 (1)	10.00	G-O	0 2086	0.46 (1)	10.00
P-B	-1848 0	0.0	0.0	0.17 (1)	6.45	K-H	0 -1493	0.34 (1)	10.00
J-H	-1705 0	0.0	0.0	0.36 (1)	8.37				
P-O	0 0	-18.5	-18.5	0.26 (4)	10.00				
O-N	0 2053	-18.5	-18.5	0.46 (1)	10.00				
N-M	0 1383	-18.5	-18.5	0.31 (1)	10.00				
M-L	0 1383	-18.5	-18.5	0.31 (1)	10.00				
L-K	0 934	-18.5	-18.5	0.24 (4)	10.00				
K-J	0 0	-18.5	-18.5	0.16 (4)	10.00				

TOTAL WEIGHT = 126 lb (MIF)

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.96")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (0.96")
CALCULATED VERT. DEFL.(TL) = L/999 (0.19")

CS1: TC=0.84/1.00 (B-C:1), BC=0.46/1.00 (N-O:1), WB=0.46/1.00 (B-C:1), SS=0.30/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (K) (INPUT = 0.90)
JSI METAL= 0.62 (B) (INPUT = 1.00)




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408039	T54	3	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 14:59:51 2020 Page 1

ID:DMCubiNVR6TSiFoe31v6I_zns11-o X1wkzi5lq7BIXCksJfRqaYs9mpulXek27OzNUPM

Scale = 1:55.5

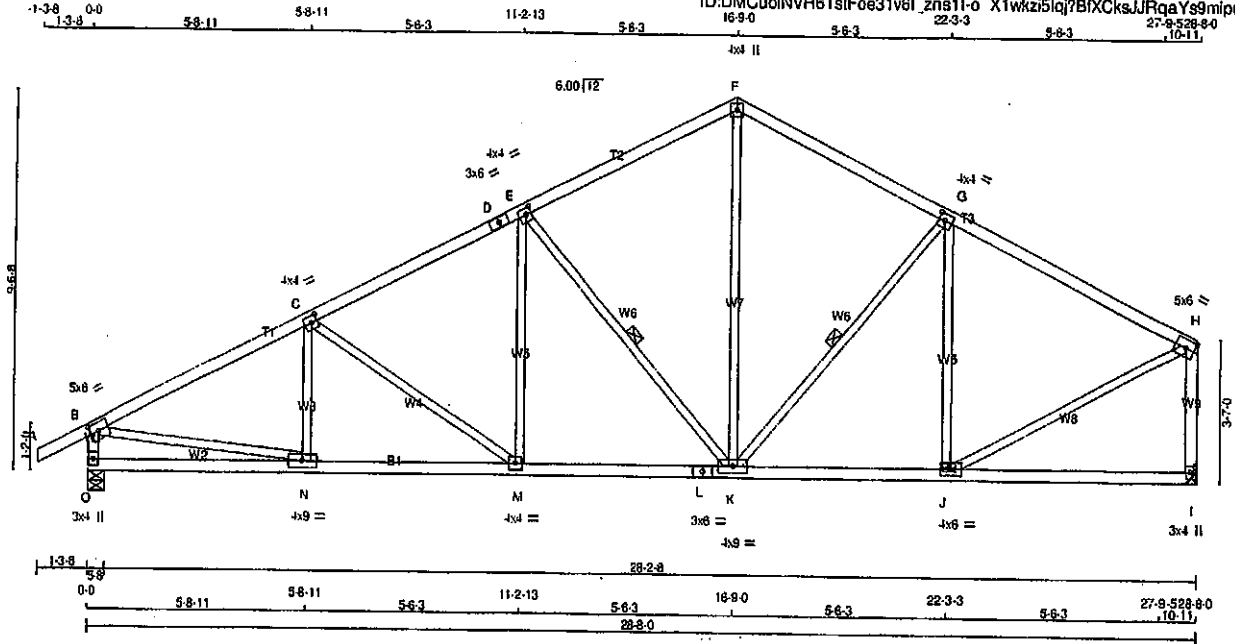

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
O - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
O - L	2x4	DRY	No.2
L - I	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	5.0	6.0	2.50	2.75
C, E, G						
C	TMVW-1	MT20	4.0	4.0	2.00	1.75
D	TS-1	MT20	3.0	6.0		
F	TTW-p	MT20	4.0	4.0		
H	TMVW-1	MT20	5.0	6.0		Edge
I	BMV1-p	MT20	3.0	4.0		
J	BMVW-1	MT20	4.0	6.0		
K	BMVW-1	MT20	4.0	6.0		
L	BS-1	MT20	3.0	6.0		
M	BMVW-1	MT20	4.0	4.0		
N	BMVW-1	MT20	4.0	4.0		
O	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		RECORD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
O	1705	0	1705	0	0	5-8	5-8		
I	1580	0	1580	0	0	MECHANICAL			

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
O	1203	893	0	0	0	400	0
I	1118	733	0	0	0	384	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.14 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-K, G-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO				FR-TO			
A-B	0 28	-91.8	-91.8 0.12 (1)	10.00	N-C	-193	26
B-C	-2249 0	-91.8	-91.8 0.44 (1)	4.14	C-M	-381	0
C-D	-1917 0	-91.8	-91.8 0.38 (1)	4.53	M-E	0	314
D-E	-1917 0	-91.8	-91.8 0.38 (1)	4.53	E-K	-800	0
E-F	-1359 0	-91.8	-91.8 0.35 (1)	5.18	K-F	0	812
F-G	-1370 0	-91.8	-91.8 0.45 (1)	4.99	K-G	-137	0
G-H	-1409 0	-91.8	-91.8 0.49 (1)	4.89	J-G	-533	0
O-B	-1859 0	0.0	0.0 0.17 (1)	8.44	J-H	0	1444
I-H	-1531 0	0.0	0.0 0.32 (1)	6.85	B-N	0	2053
O-N	0 0	-18.5	-18.5 0.13 (4)	10.00			
N-M	0 2030	-18.5	-18.5 0.38 (1)	10.00			
M-L	0 1715	-18.5	-18.5 0.33 (1)	10.00			
L-K	0 1715	-18.5	-18.5 0.33 (1)	10.00			
K-J	0 1285	-18.5	-18.5 0.29 (1)	10.00			
J-I	0 0	-18.5	-18.5 0.17 (4)	10.00			

TOTAL WEIGHT = 3 X 124 = 372 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
DL	=	6.0	PSF	
BOT CH.	LL	=	0.0	PSF
DL	=	7.4	PSF	
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.98")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.98")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CSI: TC=0.48(1.00)(G-H:1), BC=0.38(1.00)(M-N:1), WB=0.46(1.00)(B-N:1), SSL=0.25(1.00)(G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	788	1987	1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP=0.84 (B) (INPUT = 0.80)
JSI METAL=0.80 (B) (INPUT = 1.00)



JOB NAME 408039	TRUSS NAME T55	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Fri Apr 24 14:59:52 2020 Page 1	

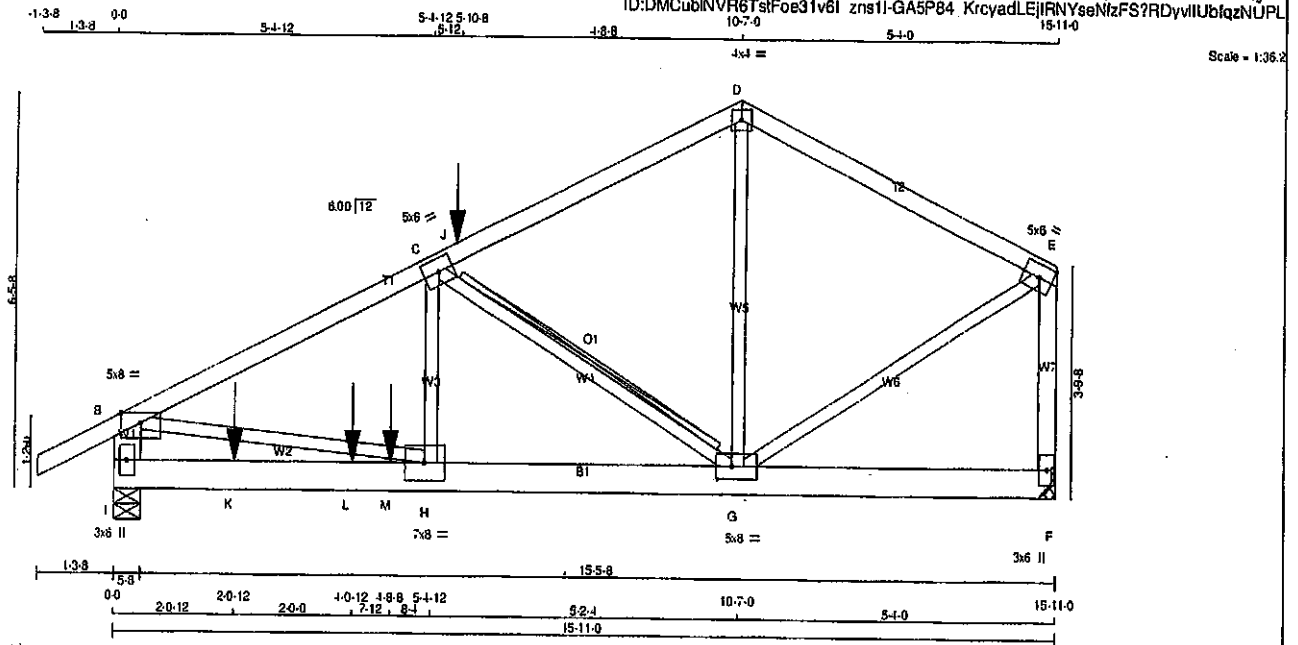

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
I - B	2x6	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
I - F	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
DRY: SEASONED LUMBER.					

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	Edge	
C TMVW-l	MT20	5.0	8.0		
D TTW-p	MT20	4.0	4.0		
E TMVW-l	MT20	5.0	8.0	Edge	
F BMV-l-p	MT20	3.0	8.0		
G BMVW-l	MT20	5.0	8.0	2.50	3.00
H BMVW-l	MT20	7.0	8.0		
I BMV-l-p	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
GROSS REACTION	GROSS REACTION	DOWN	HORIZ	UPLIFT	IN-SX	IN-SX	
JT VERT	HORIZ	DOWN	HORIZ	UPLIFT	IN-SX	IN-SX	
I 2204	0	2204	0	0	5-8	5-8	
F 1409	0	1409	0	0	MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3'-8".

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
I	1652	1058	0	0	0	494	0
F	999	671	0	0	0	323	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.13 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT C-G

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CS (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LBS)	
FR-TO		FROM	TO	FR-TO			
A-B	0 28	-91.8	-91.8 0.13 (1)	10.00	H-C	0 1047	0.28 (1)
B-C	-2942 0	-91.8	-91.8 0.83 (1)	3.13	C-G	-2022 0	0.82 (1)
C-J	-1182 0	-91.8	-91.8 0.60 (1)	4.94	G-D	0 531	0.13 (1)
J-D	-1182 0	-91.8	-91.8 0.60 (1)	4.94	B-H	0 2685	0.86 (1)
D-E	-1092 0	-91.8	-91.8 0.55 (1)	5.20	G-E	0 1158	0.29 (1)
I-B	-2017 0	0.0	0.0 0.14 (1)	7.08			
F-E	-1355 0	0.0	0.0 0.31 (1)	6.93			
I-K	0 0	-18.5	-18.5 0.44 (1)	10.00			
K-L	0 0	-18.5	-18.5 0.44 (1)	10.00			
L-M	0 0	-18.5	-18.5 0.44 (1)	10.00			
M-H	0 0	-18.5	-18.5 0.44 (1)	10.00			
H-G	0 2857	-18.5	-18.5 0.57 (1)	10.00			
G-F	0 0	-18.5	-18.5 0.07 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	FACE	DIR.	TYPE	HEEL	CONN.
J	5-10-8	-330	-330	---	FRONT	VERT	TOTAL	C1
K	2-0-12	-26	-26	---	FRONT	VERT	TOTAL	C1
L	4-0-12	-26	-26	---	FRONT	VERT	TOTAL	C1
M	4-8-8	-1352	-1352	---	FRONT	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 76 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.53")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.53")
CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.83; 1.00 (B-C:1), BC=0.57 1.00 (G-H:1), WB=0.66; 1.00 (B-H:1), SS=0.87; 1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (G) (INPUT = 0.90)
JSI METAL = 0.50 (H) (INPUT = 1.00)



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408039	T56	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

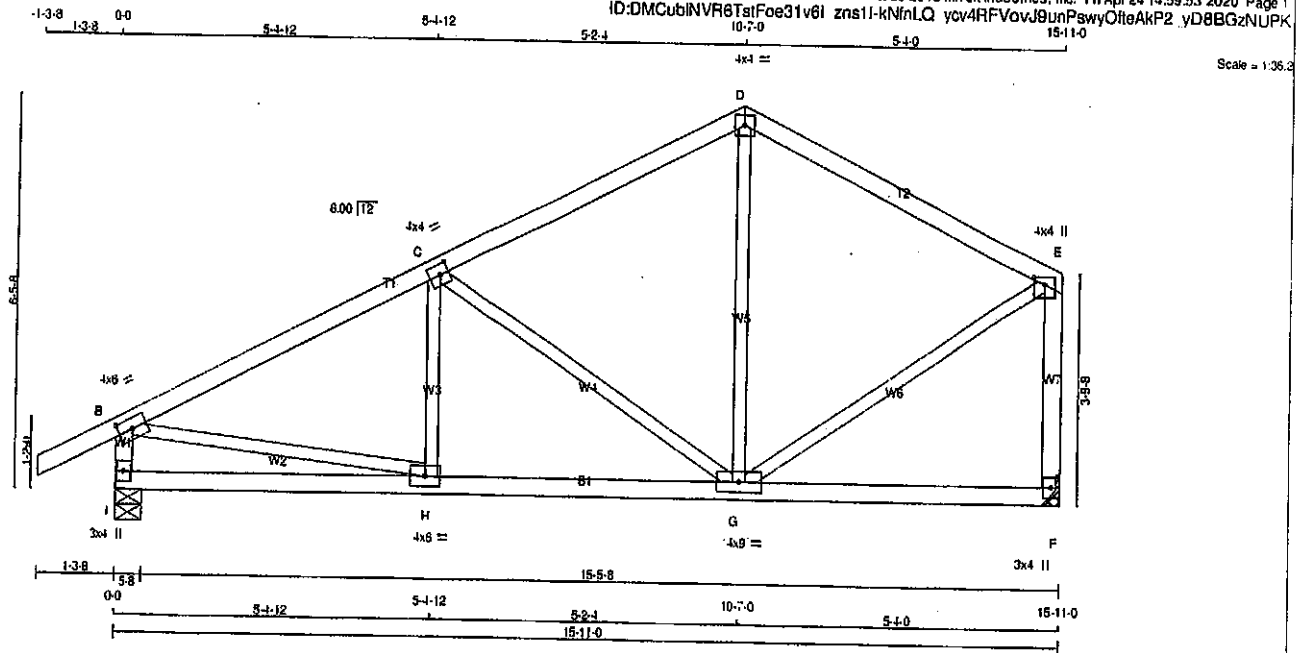

Scale = 1/32

LUMBER			
N.C.A. RULES	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - B	2x4	DRY	No.2
F - E	2x4	DRY	No.2
I - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW-1	MT20	4.0	6.0	2.00	3.00
C TMWW-1	MT20	4.0	4.0	2.00	1.75
D TTW-p	MT20	4.0	4.0		
E TMVW-p	MT20	4.0	4.0	1.50	2.00
F BMV1-p	MT20	3.0	4.0		
G BMWW-1	MT20	4.0	9.0		
H BMWW-1	MT20	4.0	6.0		
I BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
I	1002	0	1002	0	5-8	5-8
F	877	0	877	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3-8.

UNFACTORED REACTIONS

JT	1ST LCASE		MAX. MIN. COMPONENT REACTIONS		DEAD	WIND	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
I	706	477	0	0	0	0	0
F	621	407	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS I & F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.68 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 28	-91.8 -91.8	0.12 (1)	H-C	-53 66	0.02 (4)	
B-C	-1067 0	-91.8 -91.8	0.34 (1)	C-G	-562 0	0.40 (1)	
C-D	-602 0	-91.8 -91.8	0.33 (1)	G-D	0 104	0.04 (4)	
D-E	-575 0	-91.8 -91.8	0.34 (1)	B-H	0 990	0.22 (1)	
E-F	-959 0	0.0 0.0	0.10 (1)	G-E	0 614	0.14 (1)	
F-E	-838 0	0.0 0.0	0.20 (1)				
I-H	0 0	-18.5 -18.5	0.11 (4)				
H-G	0 977	-18.5 -18.5	0.23 (1)				
G-F	0 0	-18.5 -18.5	0.12 (4)				

TOTAL WEIGHT = 2 X 88 = 133 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL = 6.0	PSF	
BOT CH.	LL = 0.0	PSF
DL = 7.4	PSF	
TOTAL LOAD = 39.0	PSF	

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.53")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.53")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CS1: TC=0.34/1.00 (B-C:1), BC=0.23/1.00 (G-H:1), WB=0.40/1.00 (C-G:1), SS=0.21/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1687


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.61 (H) (INPUT = 0.90)
JSI METAL = 0.31 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006938

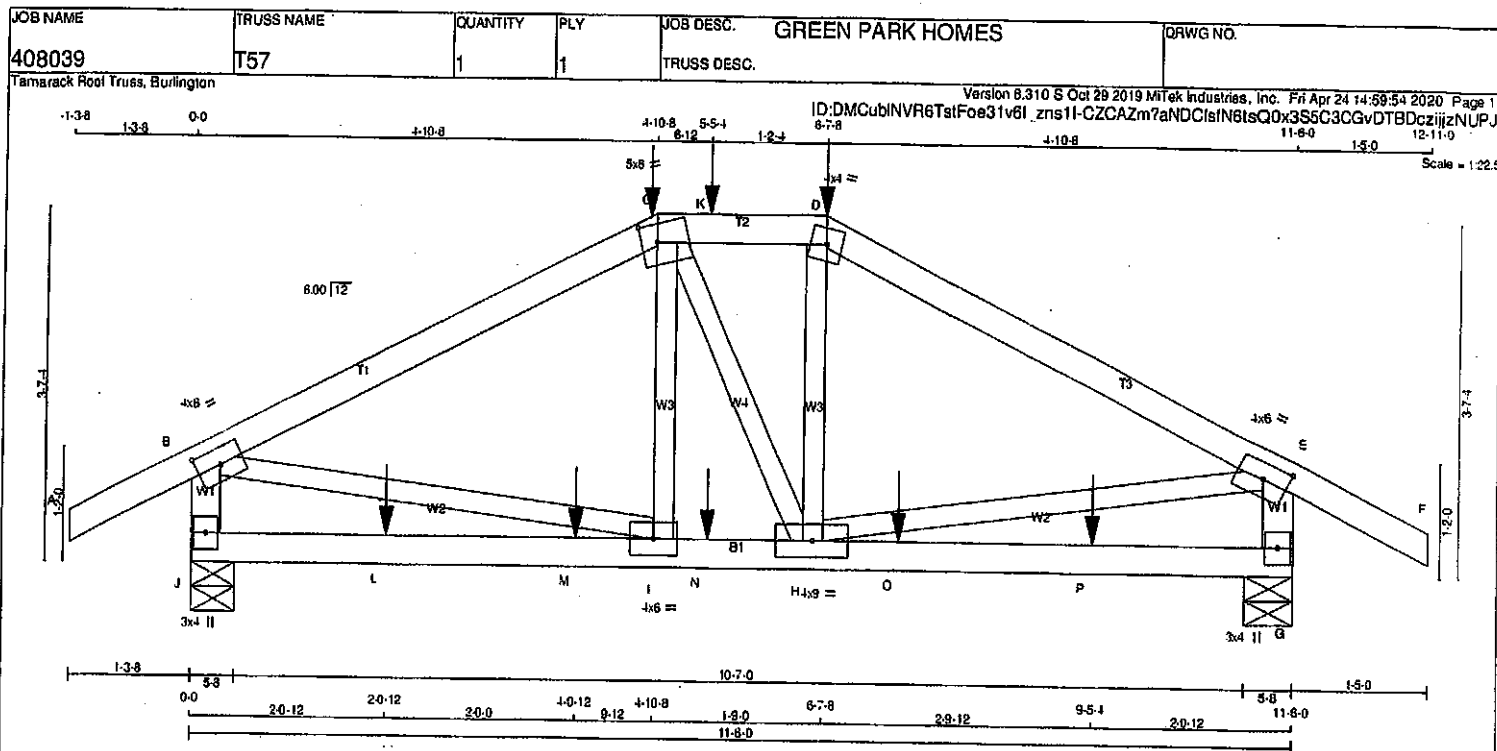

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
J - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
J - G	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table/s in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-I	MT20	4.0	6.0	2.00	3.00
C	TTWW-m	MT20	5.0	6.0	2.25	2.00
D	TTWW-m	MT20	4.0	4.0		
E	TMVW-I	MT20	4.0	6.0	2.00	3.00
G	BMV1-p	MT20	3.0	4.0		
H	BMVWW-I	MT20	4.0	9.0		
I	BMVWW-I	MT20	4.0	6.0		
J	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
J	1148	0	1148	0	0	5-8	5-8
G	1153	0	1153	0	0	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	807	553	0	0	0	254	0
G	811	557	0	0	0	254	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS J, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.10 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MEMB.
A-B	0 28	-91.8	-91.8	0.13 (1)	10.00	I-C	-87 58
B-C	-1243 0	-91.8	-91.8	0.47 (1)	5.10	C-H	-19 0
C-K	-1100 0	-91.8	-91.8	0.12 (1)	5.88	H-D	-73 60
K-D	-1100 0	-91.8	-91.8	0.12 (1)	5.88	D-I	0 1127
D-E	-1235 0	-91.8	-91.8	0.47 (1)	5.11	I-E	0 1120
E-F	0 30	-91.8	-91.8	0.16 (1)	10.00		
J-B	-1097 0	0.0	0.0	0.12 (1)	7.52		
G-E	-1101 0	0.0	0.0	0.12 (1)	7.51		
J-L	0 0	-18.5	-18.5	0.16 (4)	10.00		
L-M	0 0	-18.5	-18.5	0.16 (4)	10.00		
M-I	0 0	-18.5	-18.5	0.16 (4)	10.00		
I-N	0 1108	-18.5	-18.5	0.26 (1)	10.00		
N-H	0 1108	-18.5	-18.5	0.26 (1)	10.00		
H-O	0 0	-18.5	-18.5	0.16 (4)	10.00		
O-P	0 0	-18.5	-18.5	0.16 (4)	10.00		
P-G	0 0	-18.5	-18.5	0.16 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-10-8	-292	-292	---	BACK	VERT	TOTAL	---	C1
D	6-7-8	-292	-292	---	BACK	VERT	TOTAL	---	C1
K	5-5-4	-96	-96	---	BACK	VERT	TOTAL	---	C1
L	2-0-12	-17	-18	---	BACK	VERT	TOTAL	---	C1
M	4-0-12	-19	-19	---	BACK	VERT	TOTAL	---	C1
N	5-5-4	-19	-19	---	BACK	VERT	TOTAL	---	C1
O	7-5-4	-19	-19	---	BACK	VERT	TOTAL	---	C1
P	9-5-4	-17	-18	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1. C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.38")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.38")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.47 1.00 (B-C:1), BC=0.26 1.00 (H-I:1), WB=0.26 1.00 (B-I:1), SSI=0.17 1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1858


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.71 (I) (INPUT = 0.90)
JSI METAL = 0.35 (B) (INPUT = 1.00)



JOB NAME 408039	TRUSS NAME T58	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

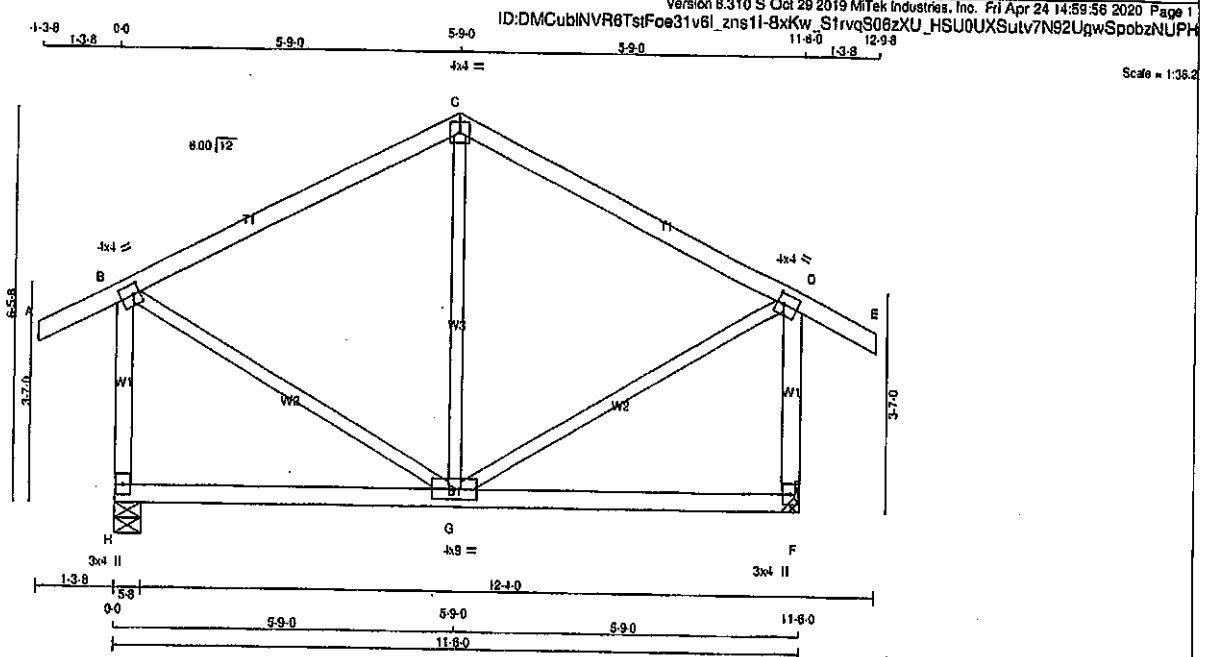

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - D	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW-1	MT20	4.0	4.0	2.00	1.25
C TTW-p	MT20	4.0	4.0		
D TMVW-1	MT20	4.0	4.0	2.00	1.25
F BMV1+p	MT20	3.0	4.0		
G BMWW-1	MT20	4.0	9.0		
H BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
H	758	0	758	0	0
F	758	0	758	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3'-8."

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	534	364	0	0	0	0	170	0
F	534	364	0	0	0	0	170	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LOI MAX	MEMB.	FORCE (LBS)	MAX	CSI (LC)
FR-TO		FROM TO	CS (LC)	FR-TO			
A-B	0 26	-91.8 -91.8	0.12 (1)	G-C	-220 18	0.15 (1)	
B-C	-344 0	-91.8 -91.8	0.39 (1)	B-G	0 355	0.08 (1)	
C-D	-344 0	-91.8 -91.8	0.39 (1)	G-D	0 355	0.08 (1)	
D-E	0 26	-91.8 -91.8	0.12 (1)				
H-B	-718 0	0.0 0.0	0.15 (1)				
F-D	-718 0	0.0 0.0	0.15 (1)				
H-G	0 0	-18.5 -18.5	0.18 (4)				
G-F	0 0	-18.5 -18.5	0.18 (4)				

TOTAL WEIGHT = 3 X 53 = 160 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9. NBCC 2010. NBCC 2015.

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.38")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.38")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.39/1.00 (C-D:1), BC=0.18/1.00 (G-H:4), WB=0.15/1.00 (C-G:1), SSI=0.18/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.54 (B) (INPUT = 0.90)
JSI METAL = 0.19 (D) (INPUT = 1.00)



JOB NAME 408039	TRUSS NAME T59S	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Fri Apr 24 14:59:57 2020 Page 1	

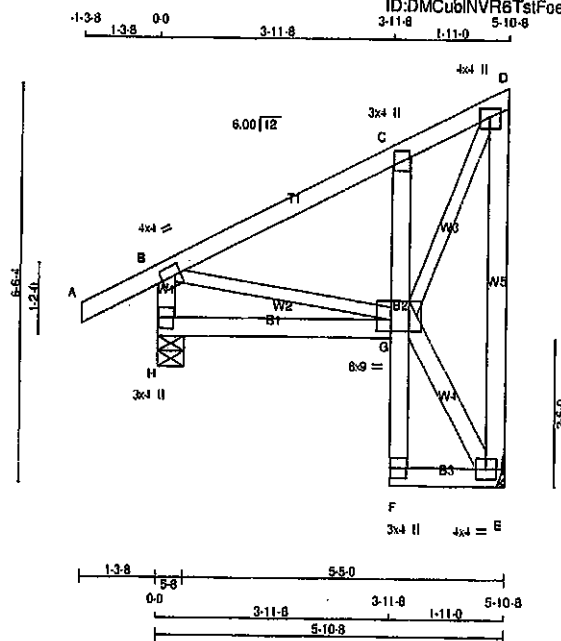

Scale = 1/32"

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
H - B	2x4	DRY	No.2
A - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
H - G	2x4	DRY	No.2
F - C	2x4	DRY	No.2
F - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
G - E	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	X
B	TMVW-1	MT20	4.0	4.0	2.00 1.25
C	TMVW-p	MT20	3.0	4.0	
D	TMVW-p	MT20	4.0	4.0	1.75 2.00
E	BMVW-1	MT20	4.0	4.0	
F	BMVW-p	MT20	3.0	4.0	
G	BMVWWW-1	MT20	6.0	9.0	2.25 3.00
H	BMVW-1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		RECORD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
H	448	0	448	0	0	5-8	5-8
E	324	0	324	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST LOASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	315	220	0	0	0	0	95	0
E	229	150	0	0	0	0	79	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	FACTORED FORCE (LBS)	LC1 MAX CSI (LC)	
FR-TO		FROM TO		FR-TO			
H-B	-410 0	0.0 0.0	0.04 (1)	B-G	0 191	0.04 (1)	
A-B	0 28	-91.8 -91.8	0.12 (1)	G-E	-9 0	0.00 (1)	
B-C	-195 0	-91.8 -91.8	0.18 (1)	G-D	0 411	0.09 (1)	
C-D	-228 0	-91.8 -91.8	0.18 (1)				
E-D	-300 0	0.0 0.0	0.25 (1)				
H-G	0 0	-18.5 -18.5	0.09 (4)				
F-G	0 18	0.0 0.0	0.02 (1)				
G-C	-365 0	0.0 0.0	0.02 (1)				
F-E	0 6	-18.5 -18.5	0.02 (4)				

TOTAL WEIGHT = 3 X 39 = 116 L

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.02")

CSI: TC=0.26/1.00 (D-E:1), BC=0.09/1.00 (G-H:4), WB=0.09/1.00 (D-G:1), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.59 (G) (INPUT = 0.90)
JSI METAL = 0.12 (B) (INPUT = 1.00)




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408039	T61S	1	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

ID:DMCubINVR6TslFoe31v6l zns1l-ZW03cT3jClqazQG3gP?B979y4xeaWuxMugTPwzNUPE

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Fri Apr 24 14:59:59 2020 Page 1

Scale = 1:28.4

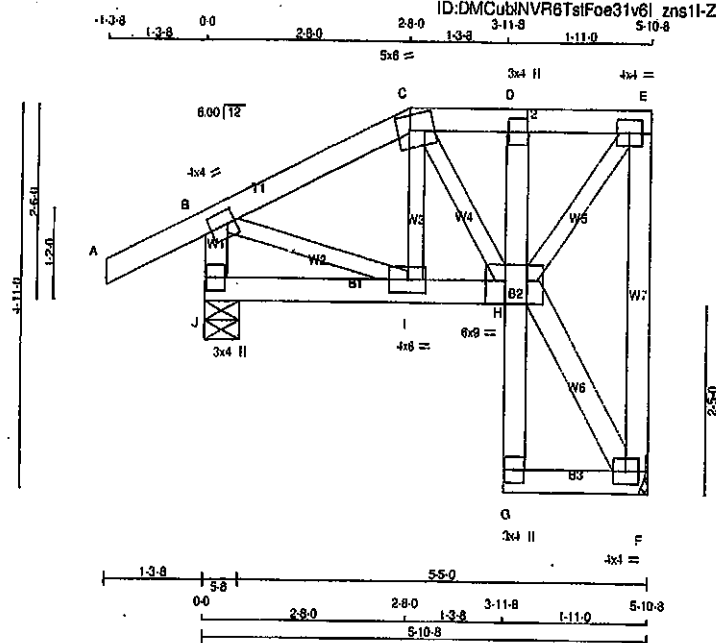

LUMBER				DESCR.	
N. L. G. A. RULES					
CHORDS	SIZE	LUMBER			
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
F - E	2x4	DRY	No.2	SPF	
J - B	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
G - D	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	

ORY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	4.0	2.00	1.25
C	TTWW-m	MT20	5.0	6.0	2.25	2.00
D	TMV+p	MT20	3.0	4.0		
E	TMVW-1	MT20	4.0	4.0		
F	BMVW-1	MT20	4.0	4.0		
G	BMV+p	MT20	3.0	4.0		
H	BMVWW-1	MT20	6.0	9.0	Edge 3.00	
I	BMVW-1	MT20	4.0	6.0		
J	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX
F	627	0	627	0	0	MECHANICAL
J	752	0	752	0	0	5-8

A SUITABLE HANGER-MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED		MAX. MIN. COMPONENT REACTIONS		LIVE	PERM.LIVE	WIND	DEAD	SOIL
	SNOW								
F	444	291	0	0	0	0	0	153	0
J	529	381	0	0	0	0	0	169	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS I, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS		FACTORED	
	MAX. FORCE (LBS)	VERT. LOAD (LBS)	MAX. (PLF)	MAX. (CSI (LC))	MAX. UNBRACED LENGTH (FT)	MEMB. FORCE (LBS)	MAX. (LBS)	MAX. (LC)
FR-TO								
A-B	0	28	-91.8	-91.8	0.13 (1)	10.00	I-C	0
B-C	-498	0	-91.8	-91.8	0.13 (1)	6.25	C-H	-174
C-D	-359	0	-91.8	-91.8	0.03 (1)	8.25	H-F	-10
D-E	-352	0	-91.8	-91.8	0.04 (1)	6.25	H-E	0
F-E	-511	0	0.0	0.0	0.21 (1)	7.81	B-I	0
J-B	-809	0	0.0	0.0	0.07 (1)	7.81		
J-I	0	0	-121.9	-121.9	0.13 (1)	10.00		
I-H	0	454	-121.9	-121.9	0.19 (1)	10.00		
G-H	0	108	0.0	0.0	0.04 (1)	10.00		
H-D	-166	0	0.0	0.0	0.02 (1)	7.81		
G-F	0	6	-121.9	-121.9	0.07 (1)	10.00		

TOTAL WEIGHT = 37 b

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

GIRDER TYPE: CSId Girder
START DISTANCE = 0-0
START SPAN CARRIED = 5-10-8
END DISTANCE = 5-10-8
END SPAN CARRIED = 5-10-8
END WALL WIDTH = 1-8
APPLIED TO FRONT SIDE OF BOTTOM CHORD.
- ADDTL LOADS BASED ON 55 % OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ORC 2012, ABC 2019
- PART 9 OF ORC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.02")

CSI: TC=0.21 (1.00 (E-F:1)), BC=0.19 (1.00 (H-I:1)), WB=0.14 (1.00 (E-H:1)), SS=0.17 (1.00 (I-J:1))

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1656

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.76 (B); INPUT = 0.90 ;
JSI METAL= 0.23 (B); INPUT = 1.00 ;



Structural component only
DWG# T-2006943

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408016	V1	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fd Apr 24 13:21:18 2020 Page 1					
ID:DMCubINVR6TstFoe31v6I_zns11-QQigwPhcXr16V85JOHhAVR9xH7BneePqCue4czNVr					

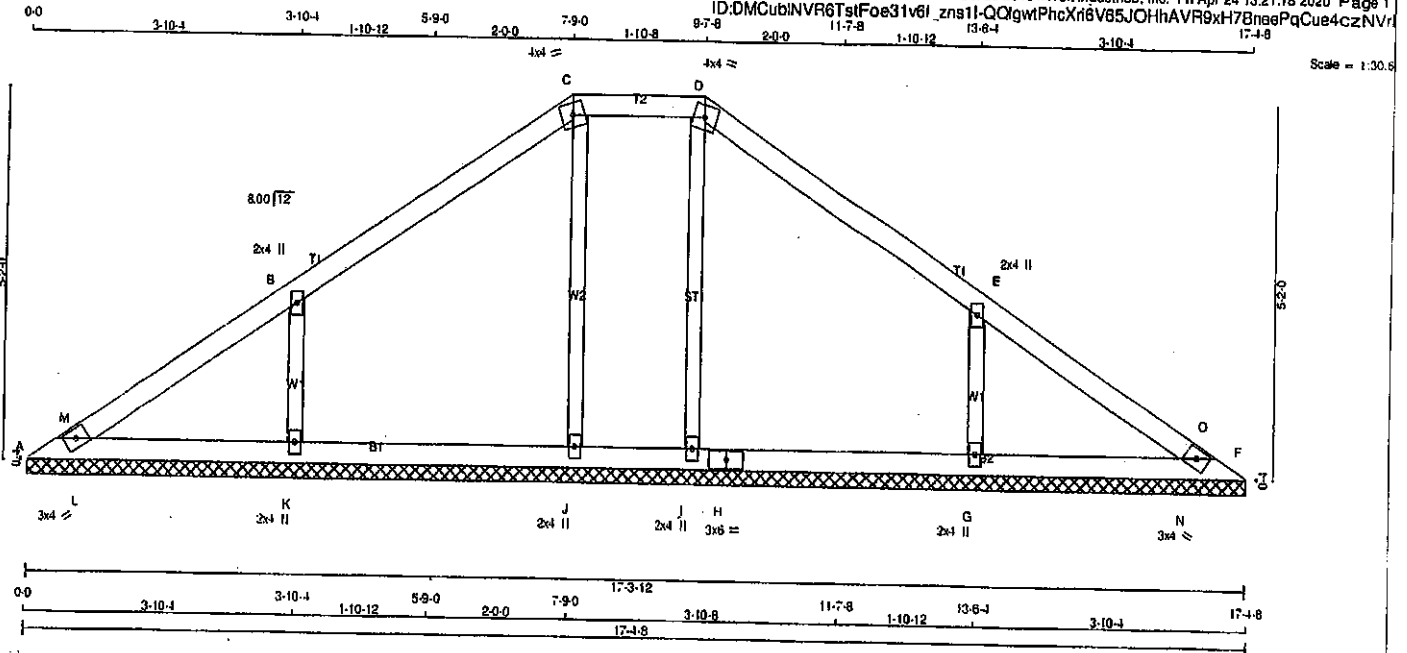

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
A - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (tables in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TBM1-h	MT20	3.0	4.0
B	TMW+w	MT20	2.0	4.0
C	TTW-m	MT20	4.0	4.0
D	TTW-m	MT20	4.0	4.0
E	TMW+w	MT20	2.0	4.0
F	TBM1-h	MT20	3.0	4.0
G, I, J, K				
G	BMW1+w	MT20	2.0	4.0
H	BS-t	MT20	3.0	6.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
A	132	0	132	0	0	17-3-12 (9-11) 123-12			
F	132	0	132	0	0	17-3-12 (9-11) 123-12			
I	308	0	308	0	0	17-3-12 (9-11) 123-12			
J	308	0	308	0	0	17-3-12 (9-11) 123-12			
G	514	0	514	0	0	17-3-12 (9-11) 123-12			
K	514	0	514	0	0	17-3-12 (9-11) 123-12			

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	93	63.0	0.0	0.0	0.0	30.0	0.0
F	93	63.0	0.0	0.0	0.0	30.0	0.0
I	219	139.0	0.0	0.0	0.0	80.0	0.0
J	219	139.0	0.0	0.0	0.0	80.0	0.0
G	363	241.0	0.0	0.0	0.0	122.0	0.0
K	363	241.0	0.0	0.0	0.0	122.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, F, I, J, G, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO		FR-TO			
A-M	0.27	-91.8 -91.8 0.04 (1)	10.00	I-D	-284 0	0.10 (1)	
M-B	0.79	-91.8 -91.8 0.23 (1)	10.00	J-C	-284 0	0.10 (1)	
B-C	0.41	-91.8 -91.8 0.22 (1)	10.00	G-E	-408 0	0.07 (1)	
C-D	0.58	-91.8 -91.8 0.06 (1)	10.00	K-B	-109 0	0.07 (1)	
D-E	0.41	-91.8 -91.8 0.22 (1)	10.00	L-M	-71 4	0.00 (1)	
E-O	0.79	-91.8 -91.8 0.23 (1)	10.00	N-O	-71 4	0.00 (1)	
O-F	0.27	-91.8 -91.8 0.04 (1)	10.00				
A-L	-50 0	-18.5 -18.5 0.07 (1)	8.25				
L-K	-37 0	-18.5 -18.5 0.07 (1)	8.25				
K-J	-52 0	-18.5 -18.5 0.07 (4)	8.25				
J-I	-58 0	-18.5 -18.5 0.04 (4)	8.25				
I-H	-52 0	-18.5 -18.5 0.07 (4)	8.25				
H-G	-52 0	-18.5 -18.5 0.07 (4)	8.25				
G-N	-37 0	-18.5 -18.5 0.07 (1)	8.25				
N-F	-50 0	-18.5 -18.5 0.07 (1)	8.25				

TOTAL WEIGHT = 53 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.23/1.00 (E-O:1), BC=0.07/1.00 (G-N:1), WB=0.10/1.00 (C-J:1), SSI=0.14/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP=0.81 (C) (INPUT = 0.90)
JSI METAL=0.21 (E) (INPUT = 1.00)



Structural component only
DWG# T-2006893

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408016	V2	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Fri Apr 24 13:21:20 2020 Page 1

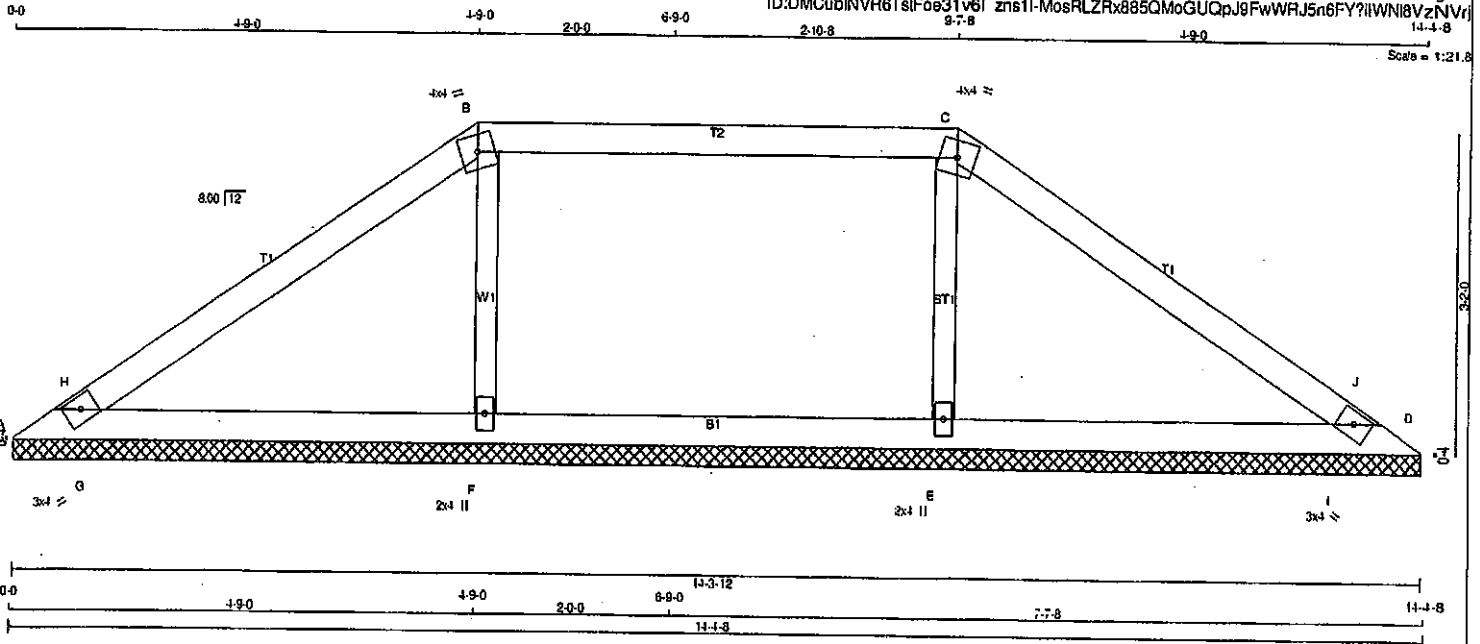

TOTAL WEIGHT = 38.5 (M)

LUMBER				DESCR.	
N. L. G. A. RULES	SIZE	LUMBER			
CHORDS					
A - B	2x4	DRY	No.2	SPF	
B - C	2x4	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
A - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (Table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TBM1-h	MT20	3.0	4.0	
B	TTW-m	MT20	4.0	4.0	
C	TTW-m	MT20	4.0	4.0	
D	TBM1-h	MT20	3.0	4.0	
E	BMW1-w	MT20	2.0	4.0	
F	BMW1-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
A	55	0	55	0	0	0	14-3-12	14-3-12	
D	55	0	55	0	0	0	14-3-12	14-3-12	
E	734	0	734	0	0	0	14-3-12	14-3-12	
F	734	0	734	0	0	0	14-3-12	14-3-12	

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
A	39	25.0	0.0	0.0	0.0	14.0	0.0		
D	39	25.0	0.0	0.0	0.0	14.0	0.0		
E	519	341.0	0.0	0.0	0.0	178.0	0.0		
F	519	341.0	0.0	0.0	0.0	178.0	0.0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS A, D, E, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED			
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FORCE (LBS)	MAX. CSI (LC)		
FR-TO		FROM TO			FR-TO				
A-H	0 373	-91.8 -91.8 0.12 (1)	10.00	E-C	-606 0	0.11 (1)			
H-B	0 377	-91.8 -91.8 0.27 (1)	10.00	F-B	-606 0	0.11 (1)			
B-C	0 340	-91.8 -91.8 0.43 (1)	10.00	G-H	-216 0	0.00 (1)			
C-J	0 377	-91.8 -91.8 0.27 (1)	10.00	I-J	-216 0	0.00 (1)			
J-D	0 373	-91.8 -91.8 0.12 (1)	10.00						
A-G	-351 0	-18.5 -18.5 0.17 (1)	6.25						
G-F	-318 0	-18.5 -18.5 0.17 (1)	6.25						
F-E	-340 0	-18.5 -18.5 0.10 (4)	6.25						
E-I	-318 0	-18.5 -18.5 0.17 (1)	6.25						
I-D	-351 0	-18.5 -18.5 0.17 (1)	6.25						

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.43/1.00 (B-C:1), BC=0.17/1.00 (E-I:1), WB=0.11/1.00 (C-E:1), SS=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.46 (C) (INPUT = 0.90)
JSI METAL = 0.23 (C) (INPUT = 1.00)

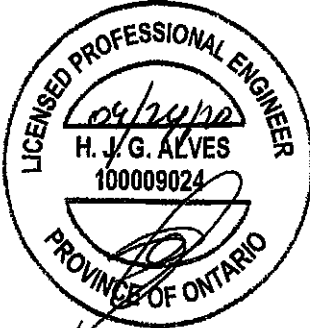

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408038	V20	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 14:38:25 2020 Page 1
ID:DMCubINVR6Ts!Foe31v6I zns1l-Saqt10P1xAoBjZLMsfokCFZlgSK_OHCTp2D_wzNUjS

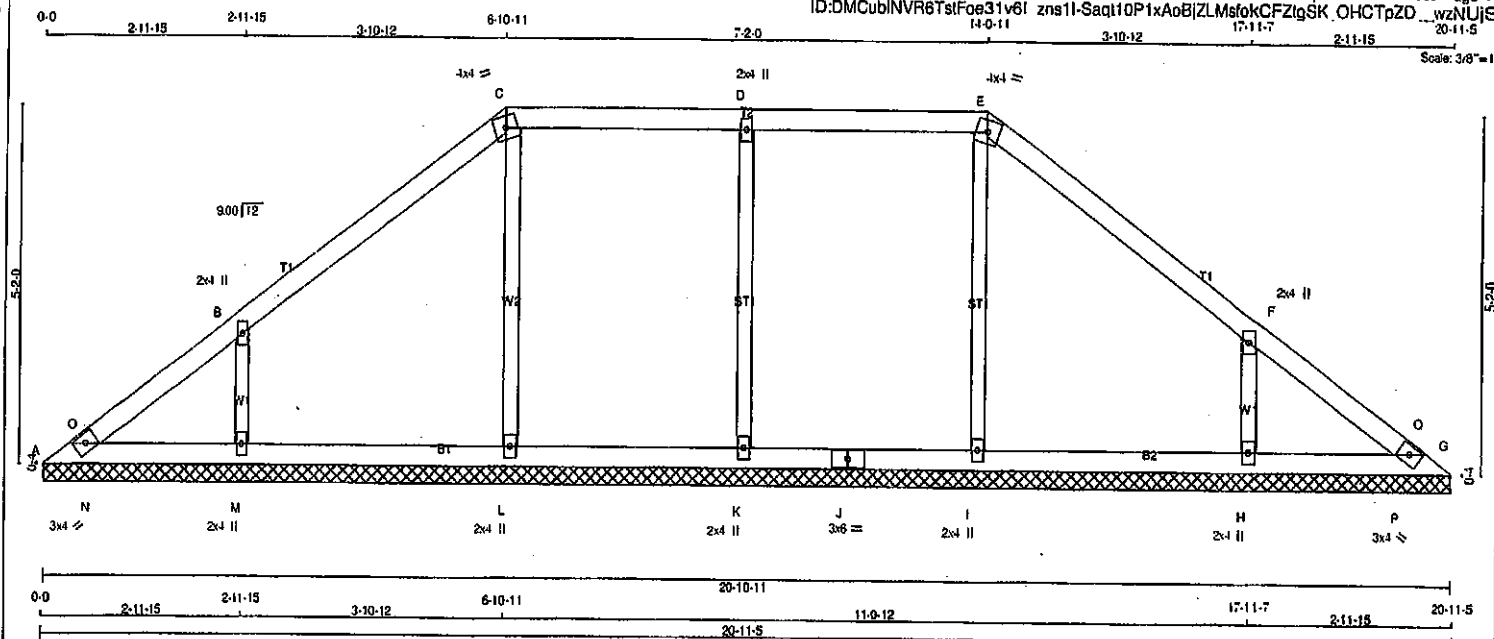

TOTAL WEIGHT = 64 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - E	2x4	DRY	No.2	SPF		
E - G	2x4	DRY	No.2	SPF		
A - J	2x4	DRY	No.2	SPF		
J - G	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
DRY: SEASONED LUMBER.						

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
A - TBM1-h	MT20	3.0	4.0			
B, D, F						
C - TMW+w	MT20	2.0	4.0			
E - TTW-m	MT20	4.0	4.0			
G - TBM1-h	MT20	3.0	4.0			
H, I, K, L, M						
H - BMW1+w	MT20	2.0	4.0			
J - BS-1	MT20	3.0	6.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	DOWN	HORIZ	UPLIFT
JT	VERT	HQZ	IN-SX	IN-SX
A	124	0	0	20-10-11 (8-100-50-11)
G	124	0	0	20-10-11 (8-100-50-11)
I	325	0	0	20-10-11 (8-100-50-11)
K	472	0	0	20-10-11 (8-100-50-11)
L	325	0	0	20-10-11 (8-100-50-11)
M	466	0	0	20-10-11 (8-100-50-11)
H	466	0	0	20-10-11 (8-100-50-11)

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	87	80.0	0.0	0.0	0.0	27.0	0.0
G	87	80.0	0.0	0.0	0.0	27.0	0.0
I	232	140.0	0.0	0.0	0.0	93.0	0.0
K	332	229.0	0.0	0.0	0.0	102.0	0.0
L	232	140.0	0.0	0.0	0.0	93.0	0.0
M	329	220.0	0.0	0.0	0.0	109.0	0.0
H	329	220.0	0.0	0.0	0.0	109.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, G, I, K, L, M, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED	MAX.
MEMB.	FORCE (LBS)	VERT. LOAD	LC1	MAX	MAX.	MEMB.	FORCE (LBS)	MAX	MAX.
FR-TO	FROM	TO	FROM	TO	LENGTH	FR-TO	FROM	TO	LENGTH
A-O	-60.0	-91.8	-91.8	0.04 (1)	6.25	I-E	-257.0	0.10 (11)	
O-B	0.7	-91.8	-91.8	0.20 (1)	10.00	K-D	-410.0	0.15 (1)	
B-C	-45.0	-91.8	-91.8	0.20 (1)	6.25	L-C	-257.0	0.10 (11)	
C-D	-13.2	-91.8	-91.8	0.20 (1)	6.25	M-B	-384.0	0.05 (1)	
D-E	-13.2	-91.8	-91.8	0.20 (1)	6.25	H-F	-384.0	0.05 (1)	
E-F	-45.0	-91.8	-91.8	0.20 (1)	6.25	N-O	-21.5	0.00 (11)	
F-G	0.7	-91.8	-91.8	0.20 (1)	10.00	P-Q	-21.5	0.00 (11)	
O-G	-60.0	-91.8	-91.8	0.04 (1)	6.25				
A-N	0.31	-18.5	-18.5	0.04 (1)	10.00				
N-M	0.37	-18.5	-18.5	0.05 (4)	10.00				
M-L	-1.18	-18.5	-18.5	0.05 (4)	10.00				
L-K	-2.13	-18.5	-18.5	0.05 (4)	10.00				
K-J	-2.13	-18.5	-18.5	0.05 (4)	10.00				
J-I	-2.13	-18.5	-18.5	0.05 (4)	10.00				
I-H	-1.18	-18.5	-18.5	0.05 (4)	10.00				
H-P	0.37	-18.5	-18.5	0.05 (4)	10.00				
P-G	0.31	-18.5	-18.5	0.04 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00:12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TO=0.20:1.00 (C-D:1), BC=0.05:1.00 (H-P:4), WB=0.16:1.00 (D-K:1), SS=0.16:1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.82 (E) (INPUT = 0.90)
JSI METAL = 0.20 (F) (INPUT = 1.00)




Structural component only
DWG# T-2006918

JOB NAME 408038	TRUSS NAME V21	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 24 14:38:27 2020 Page 1

ID:DMCubINVR6TstF0e31v6l_zns11-OzxdRIQITn2vzIVL_4qCHqfAuG_vsCbmGti52pzNjQ

Scale = 1:27.8

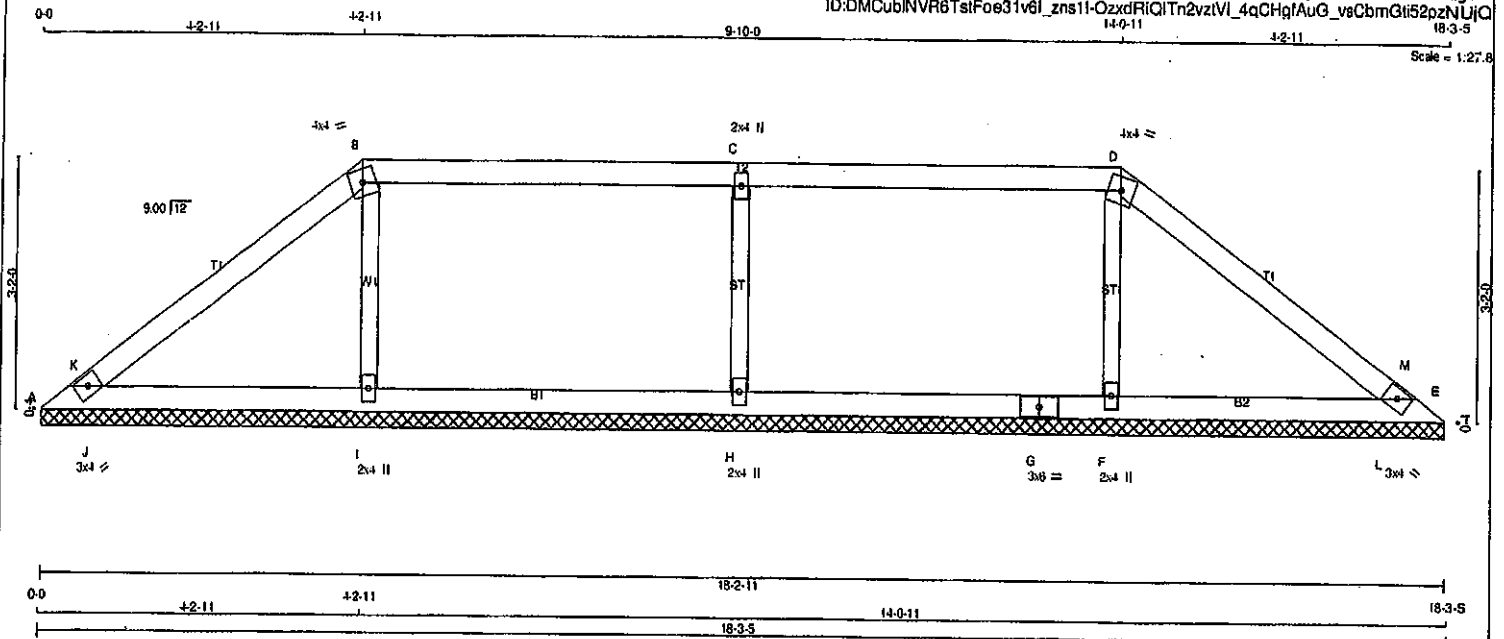

TOTAL WEIGHT = 49 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4 DRY	No.2	SPF
B - D	2x4 DRY	No.2	SPF
D - E	2x4 DRY	No.2	SPF
A - G	2x4 DRY	No.2	SPF
G - E	2x4 DRY	No.2	SPF
ALL WEBS 2x3 DRY No.2 SPF			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TBM1-h	MT20	3.0	4.0	
B	TTW-m	MT20	4.0	4.0	
C	TMW-w	MT20	2.0	4.0	
D	TTW-m	MT20	4.0	4.0	
E	TBM1-h	MT20	3.0	4.0	
F, H, I					
F	BMW1-w	MT20	2.0	4.0	
G	BS-t	MT20	3.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REORD BRG	
JT		VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX		
A	93	0	93	0	0	18-2-11	12-118-2-1		
E	93	0	93	0	0	18-2-11	12-118-2-1		
F	596	0	596	0	0	18-2-11	12-118-2-1		
H	632	0	632	0	0	18-2-11	12-118-2-1		
I	596	0	596	0	0	18-2-11	12-118-2-1		

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
A	85	44	0	0	0	22	0
E	85	44	0	0	0	22	0
F	422	271	0	0	0	151	0
H	445	302	0	0	0	143	0
I	422	271	0	0	0	151	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, F, H, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-K	0 225	F-D	-457 0
K-B	0 222	H-C	-565 0
B-C	0 198	I-B	-457 0
C-D	0 198	J-K	-201 0
D-M	0 222	L-M	-201 0
M-E	0 225		
A-J	-215 0		
J-I	-182 0		
I-H	-198 0		
H-G	-198 0		
G-F	-198 0		
F-L	-182 0		
L-E	-215 0		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.8 PSF
DL	= 6.0 PSF
80T CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.41 1.00 (B-C:1), BC=0.15/1.00 (F-L:1), WB=0.10/1.00 (C-H:1), SS=0.22/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MT20	618	354	1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.82 (D) (INPUT = 0.90)

JSI METAL= 0.18 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006919

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408039	V45	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 15:00:00 2020 Page 1	
				ID:DMCubINVR6TstFoe31v6I_zns1I-1jaRpp4Lz3yRaarFD7WQBK9UUXJ Q4bYQ0xMzNUJPD	

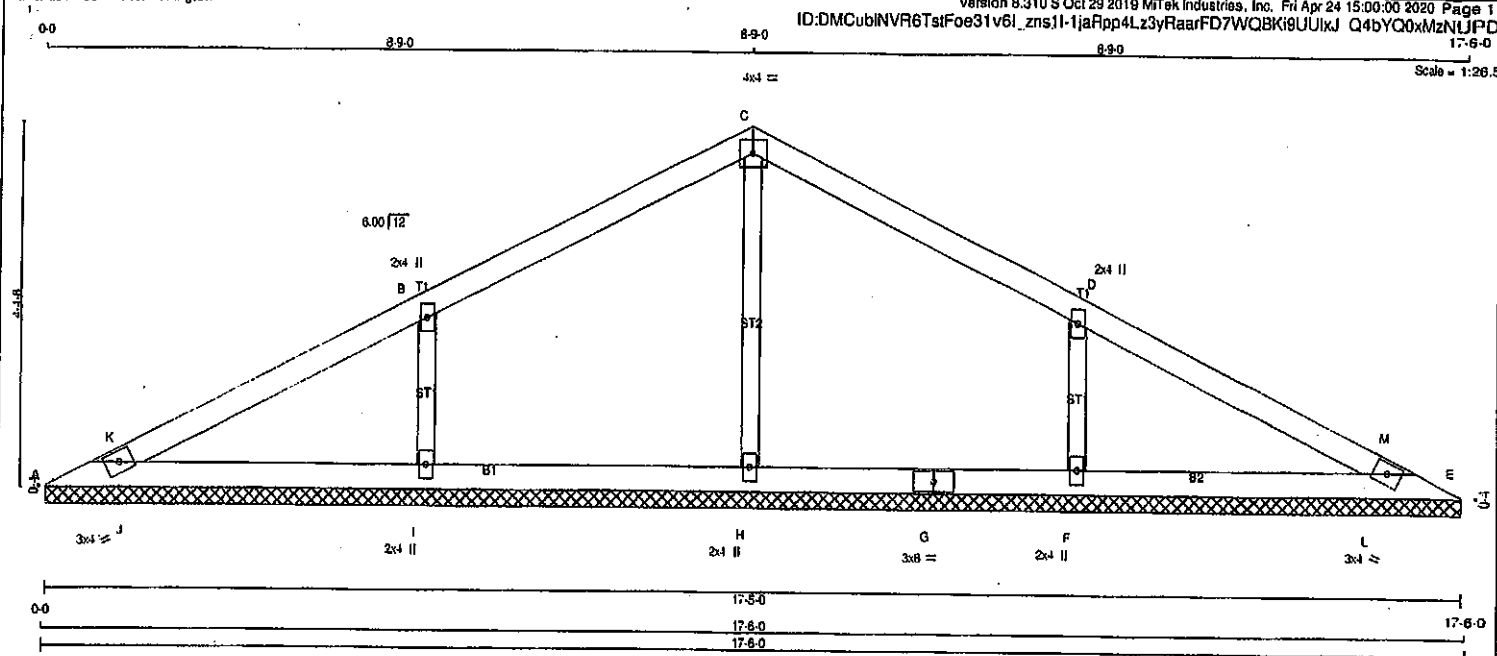

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESC.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
A - G	2x4	DRY	No.2
G - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TBM1-h	MT20	3.0	4.0
B	TMW-w	MT20	2.0	4.0
C	TTW-p	MT20	4.0	4.0
D	TMW-w	MT20	2.0	4.0
E	TBM1-h	MT20	3.0	4.0
F, H, I				
F	BMW1-w	MT20	2.0	4.0
G	BS-I	MT20	3.0	6.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT		GROSS REACTION		GROSS REACTION		BRG		BRG	
		VERT	HORZ	DOWN	HORZ	IN-SX		IN-SX	
A	141	0	141	0	0	17-5-0	6-5-4	17-5-0	
E	141	0	141	0	0	17-5-0	6-5-4	17-5-0	
H	479	0	479	0	0	17-5-0	6-5-4	17-5-0	
I	580	0	580	0	0	17-5-0	6-5-4	17-5-0	
F	580	0	580	0	0	17-5-0	6-5-4	17-5-0	

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS		1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
A	99	87.0	0.0	0.0	0.0	33.0	0.0		
E	99	87.0	0.0	0.0	0.0	33.0	0.0		
H	341	212.0	0.0	0.0	0.0	129.0	0.0		
I	409	273.0	0.0	0.0	0.0	138.0	0.0		
F	409	273.0	0.0	0.0	0.0	138.0	0.0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, E, H, I, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORZ. LOAD (LBS)
FR-TO		FROM TO	PR-TO
A-K	0 139	-91.8 -91.8 0.07 (1)	10.00
K-B	0 184	-91.8 -91.8 0.28 (1)	10.00
B-C	0 153	-91.8 -91.8 0.28 (1)	10.00
C-D	0 153	-91.8 -91.8 0.28 (1)	10.00
D-M	0 184	-91.8 -91.8 0.28 (1)	10.00
M-E	0 139	-91.8 -91.8 0.07 (1)	10.00
A-J	-154 0	-18.5 -18.5 0.12 (1)	6.25
J-I	-140 0	-18.5 -18.5 0.12 (1)	6.25
I-H	-155 0	-18.5 -18.5 0.09 (1)	6.25
H-G	-155 0	-18.5 -18.5 0.09 (1)	6.25
G-F	-155 0	-18.5 -18.5 0.09 (1)	6.25
F-L	-140 0	-18.5 -18.5 0.12 (1)	6.25
L-E	-154 0	-18.5 -18.5 0.12 (1)	6.25

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 084-09, CSA 085-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TO=0.29/1.00 (D-M:1), BC=0.12/1.00 (F-L:1), WS=0.12/1.00 (C-H:1), SS=0.18/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.40 (D) (INPUT = 0.90)
JSI METAL=0.19 (D) (INPUT = 1.00)



Structural component only
DWG# T-2008944

JOB NAME 408039	TRUSS NAME V46	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

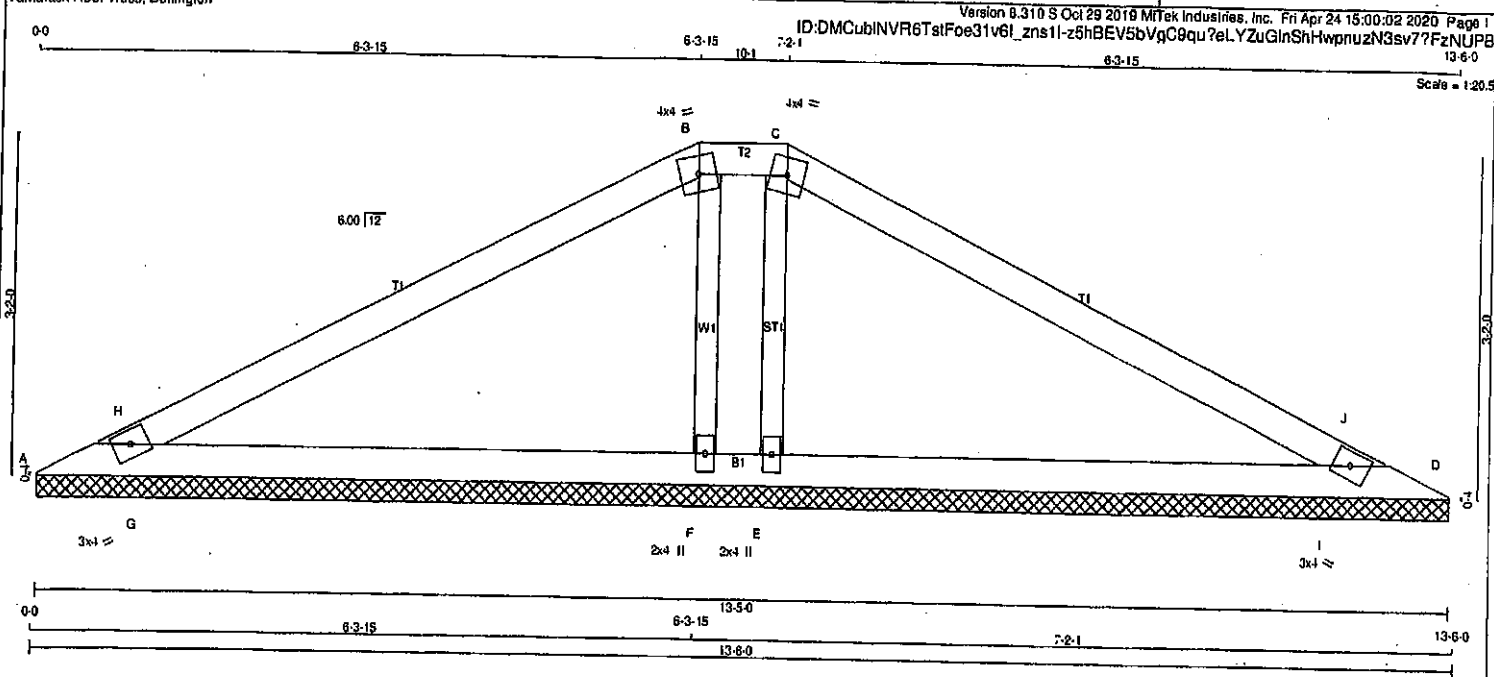

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
A - D	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B	TTW-m	MT20	4.0	4.0		
C	TTW-m	MT20	4.0	4.0		
D	TBM1-h	MT20	3.0	4.0		
E	BMW1+w	MT20	2.0	4.0		
F	BMW1+w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
A	-22	0	0	0	-22	13-5-0
D	-22	0	0	0	-22	13-5-0
E	762	0	762	0	0	13-5-0
F	762	0	762	0	0	13-5-0

PROVIDE ANCHORAGE AT BEARING JOINT A FOR 150 LBS FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX. MIN. COMPONENT REACTIONS		PERM. LIVE	WIND	DEAD	SOIL
		SNOW	LIVE				
A	-15	0	-13	0	0	0	0
D	-15	0	-13	0	0	0	0
E	538	358	0	0	0	0	0
F	538	358	0	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS (A, D, E, F)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)		MAX. CS (LBS)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LBS)
		FROM	TO					
FR-TO						FR-TO		
A-H	0 837	-91.8	-91.8	0.28 (1)	10.00	E-C	-639 0	0.12 (1)
H-B	0 835	-91.8	-91.8	0.50 (1)	10.00	F-B	-639 0	0.12 (1)
B-C	0 778	-91.8	-91.8	0.14 (1)	10.00	G-H	-304 0	0.00 (1)
C-J	0 835	-91.8	-91.8	0.50 (1)	10.00	I-J	-304 0	0.00 (1)
J-D	0 837	-91.8	-91.8	0.28 (1)	10.00			
A-G	-789 0	-18.5	-18.5	0.27 (1)	6.25			
G-F	-755 0	-18.5	-18.5	0.28 (1)	6.25			
F-E	-778 0	-18.5	-18.5	0.24 (1)	6.25			
E-I	-755 0	-18.5	-18.5	0.28 (1)	6.25			
I-D	-789 0	-18.5	-18.5	0.27 (1)	6.25			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.50/1.00 (C-J:1), BC=0.28/1.00 (E-I:1), WB=0.12/1.00 (C-E:1), SB=0.18/1.00 (C-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1867

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.80 (C) (INPUT = 0.90)
JSI METAL = 0.37 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006945

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408016	J1	19	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 24 13:20:51 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns11DcTFa4zESXNLYvDEIMappSrPuzySaRdVkeqzNVsA

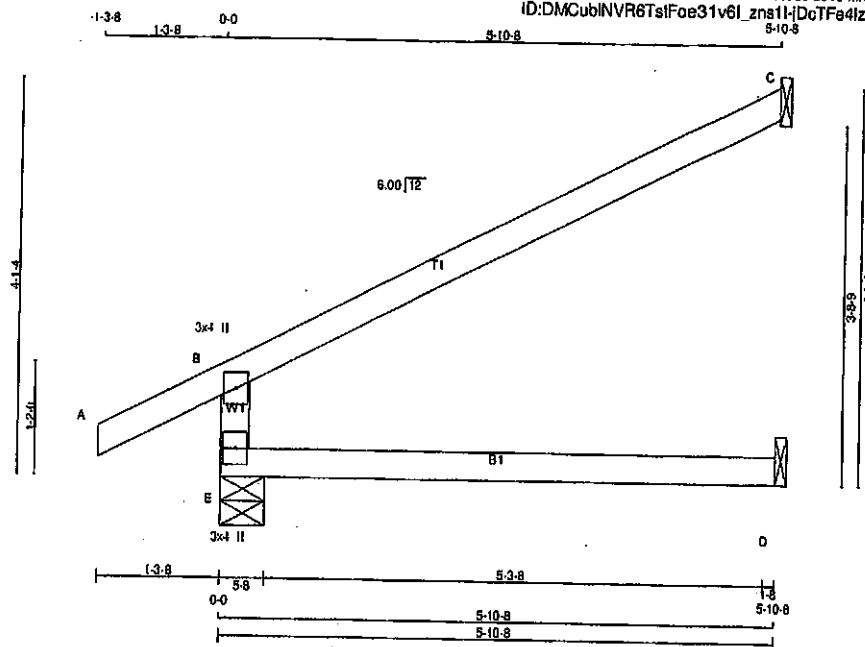

Scale = 1/22.5

LUMBER	N.L.G.A. RULES	CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2		
A - C	2x4	DRY	No.2		
E - D	2x4	DRY	No.2		

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQD
		GROSS REACTION		GROSS REACTION		BRG	BRG
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
E		525	0	525	0	0	5-8
C		202	0	202	0	0	1-8
D		45	0	50	0	0	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX. MIN. COMPONENT REACTIONS				DEAD	SOIL
		SNOW	LIVE	PERM. LIVE	WIND		
E	369	257	0	0	0	111	0
C	139	113	0	0	0	29	0
D	38	0	0	0	0	36	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO				
E-B	-461	0	0	0
A-B	0	28	-91.8	-91.8
B-C	-30	0	-91.8	-91.8
E-D	0	0	-18.5	-18.5

TOTAL WEIGHT = 19 X 17 = 319 lb

DESIGN CRITERIA

SPECIFIED LOADS:	
TOP CH. LL	= 25.6 PSF
DL	= 8.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (A:0), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

PLATE GRIP(DRY) SHEAR SECTION	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	789	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (E) (INPUT = 0.90)
JSI METAL = 0.13 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006870

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408016	J2	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 13:20:52 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns1I-BQArT_5NkXaO?V75nxbp60MdcPjHvqas9bHA7zNVs9

Scale = 1:28.9

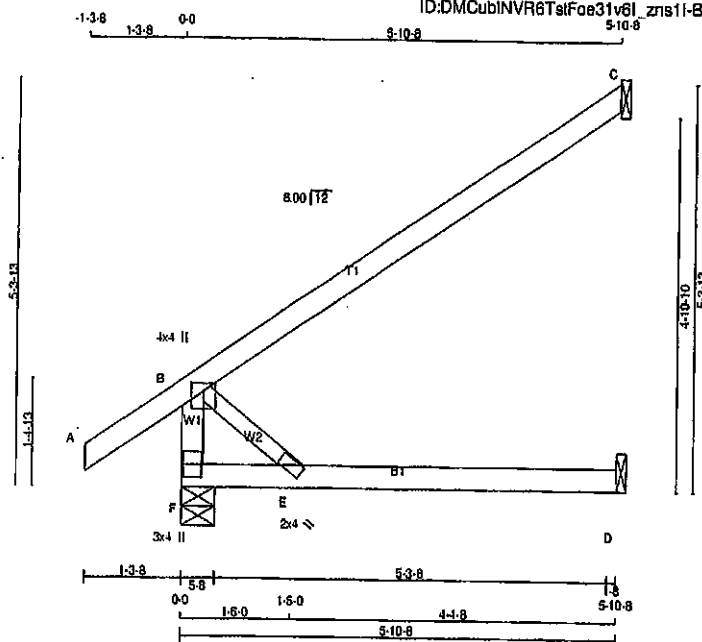

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
ORY: SEASONED LUMBER.					

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00	
E	BMVW+w	MT20	2.0	4.0			
F	BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
F	450	0	450	0	5-8	5-8
C	270	0	270	0	1-8	1-8
D	54	0	61	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	318	221.0	0.0	0.0	0.0	95.0	0.0
C	186	150.0	0.0	0.0	0.0	35.0	0.0
D	43	0.0	0.0	0.0	0.0	43.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM	TO			FR-TO			
F-B	-395.0	0.0	0.0	0.04 (1)	7.81	B-E	0.0	0.00 (1)	
A-B	0.35	-91.8	-91.8	0.12 (1)	10.00				
B-C	0.0	-91.8	-91.8	0.54 (1)	10.00				
F-E	0.0	-18.5	-18.5	0.14 (4)	10.00				
E-D	0.0	-18.5	-18.5	0.19 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2010
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CS: TC=0.54/1.00 (B-C:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.28 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006871

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408016	J3	9	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 13:20:53 2020 Page 1
ID:DMCubINV6TslFoe31vbl_zns11-fckDpK67VriFclLeKqfEurmCZlQM4k4pKniZzNVs8

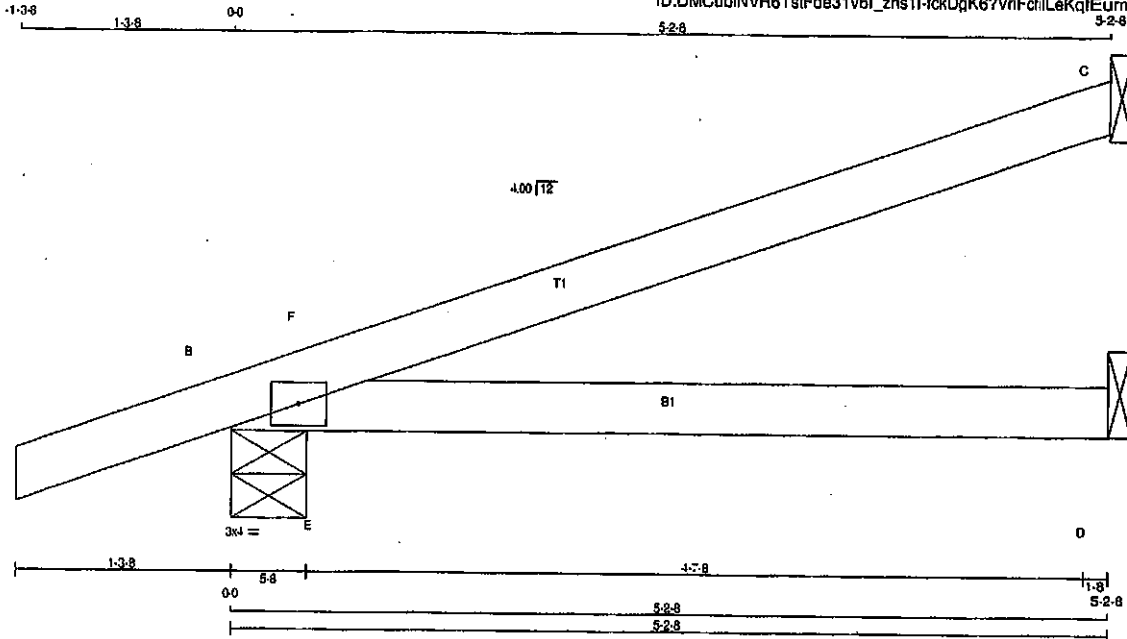

Scale = 1:12.5

LUMBER	
N. L. G. A. RULES	
CHORDS	SIZE
A - C	2x4 DRY
B - D	2x4 DRY
	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB14	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
C	208	0	208	0	1-8	1-8
B	410	0	410	0	5-8	5-8
D	79	0	79	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
		COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
C	144	112	0	0	0	0	32
B	288	202	0	0	0	0	86
D	59	21	0	0	0	0	38

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED		MAX. UNBRACED LENGTH	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
			VERT. LOAD	PLF				
FR-TO								
A-B	0	18	-91.8	-91.8	0.11 (1)	10.00		
B-F	-17	8	-91.8	-91.8	0.06 (4)	8.25		
F-C	0	2	-91.8	-91.8	0.32 (1)	10.00		
B-E	0	0	-18.5	-18.5	0.23 (1)	10.00		
E-D	0	0	-18.5	-18.5	0.23 (1)	10.00		

TOTAL WEIGHT = 9 X 14 = 126 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/899 (0.04")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/895 (0.09")

CSI: TC=0.32/1.00 (C-F:1) , BC=0.29/1.00 (D-E:1) ,
WB=0.00/1.00 (E-F:1) , SS=0.22/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.27 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2008872

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408016	J4	4	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Fri Apr 24 13:20:54 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-70lctq6dG9q6EphUyMr3CHR3NowK9oslJT4OF?zNVs7

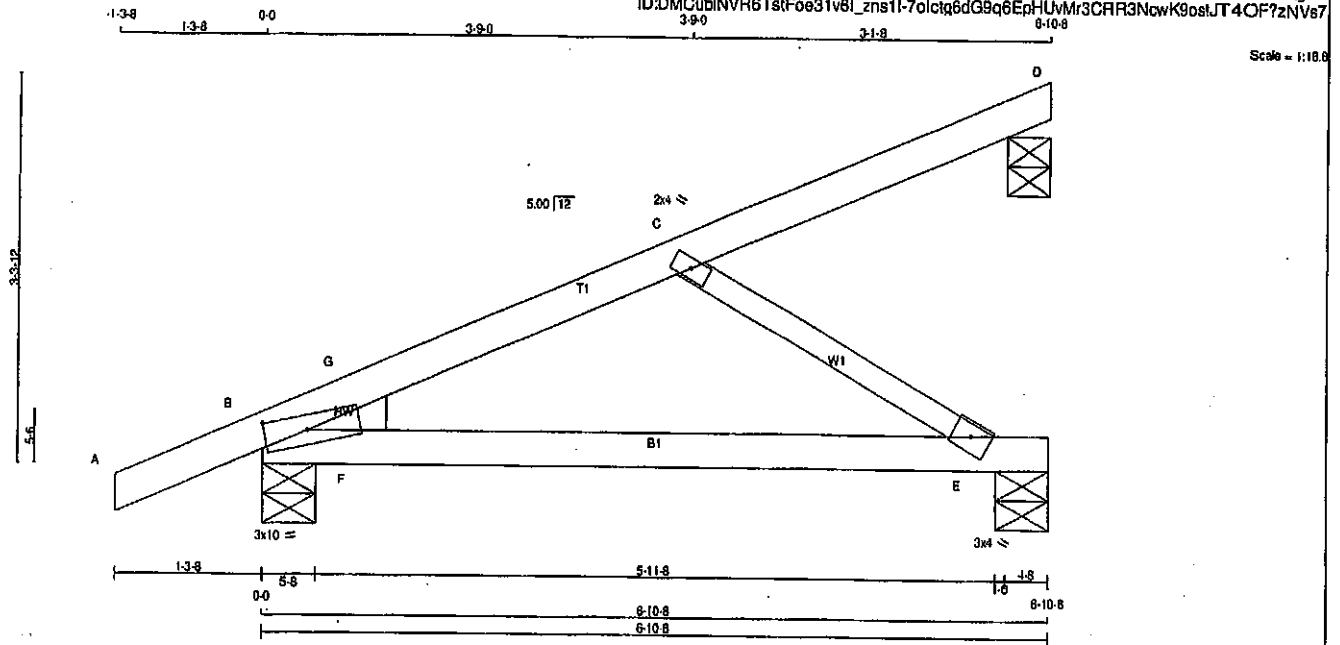

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
B - E	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMBH1-m	MT20	3.0	10.0	1.50 4.50
C	TMW+w	MT20	2.0	4.0	
E	BMW1+w	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REORD BRG	HEEL WEDGE
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
D	105	0	105	0	0
B	474	0	474	0	0
E	291	0	291	0	0

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): D

UNFACTORED REACTIONS

JT	1ST LGASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	71	62.0	0.0	0.0	0.0	9.0	0.0
B	333	233.0	0.0	0.0	0.0	100.0	0.0
E	207	126.0	0.0	0.0	0.0	81.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D, B, E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX CS1(LC)	MAX. UNBRAC LENGTH FR-TO	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1(LC)
A-B	0	-18	-91.8	-91.8	0.12 (1)	10.00	C-E	-432	0.09 (1)
B-G	-482	0	-91.8	-91.8	0.11 (4)	8.25	F-G	0	104
G-C	-381	0	-91.8	-91.8	0.14 (1)	6.25			
C-D	-16	0	-91.8	-91.8	0.14 (1)	6.25			
B-F	0	358	-18.5	-18.5	0.08 (4)	10.00			
F-E	0	358	-18.5	-18.5	0.15 (4)	10.00			

TOTAL WEIGHT = 4 X 21 = 86 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 8.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 39.0	PSF

SPACING = 24.0 IN. C.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.21")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.21")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.14/1.00 (C-G:1), BC=0.15/1.00 (E-F:4),
WB=0.09/1.00 (C-E:1), SSI=0.15/1.00 (C-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	818	354	1867	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.31 (C) (INPUT = 0.90)
JSI METAL= 0.21 (C) (INPUT = 1.00)




Structural component only
DWG# T-2006873

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408016	J4Z	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 24 13:20:55 2020 Page 1
ID:DMCubINVR6TstFoa31v6l_zns11-b?5_507F0Syzs3Mld_Df0F5uFm1Y7pxnSzNVs6

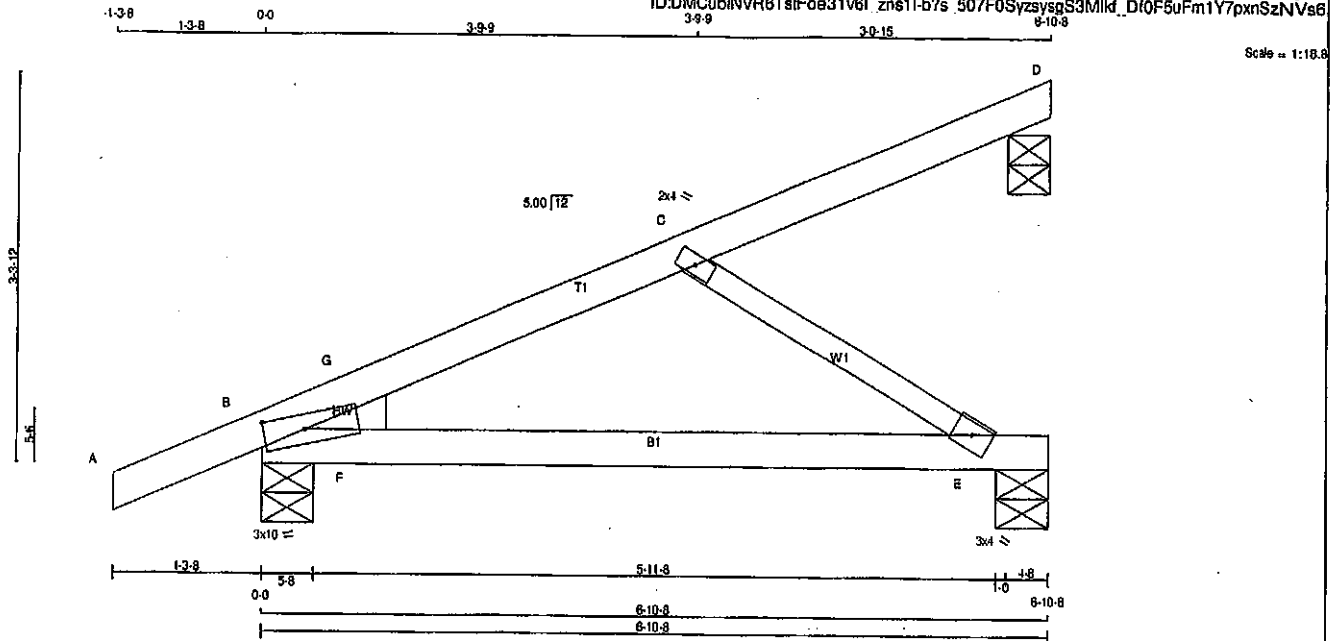

TOTAL WEIGHT = 21 b

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF		
B - E	2x4	DRY	No.2	SPF		
ALL WEBS	2x3	DRY	No.2	SPF		
DRY: SEASONED LUMBER.						

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMBH1-m	MT20	3.0	10.0	1.50	4.50
C	TMW-w	MT20	2.0	4.0		
E	BMWf-w	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG		HEEL	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX	WEDGE	
D	122	0	122	0	0	4-8	4-8	4-8	4-8	2x4 L	
B	529	0	529	0	0	5-8	5-8	5-8	5-8		
E	337	0	337	0	0	5-8	5-8	5-8	5-8		

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): D

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	84	70 0	0 0	0 0	0 0	14 0	0 0
B	371	258 0	0 0	0 0	0 0	113 0	0 0
E	240	148 0	0 0	0 0	0 0	92 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D, B, E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PL)	MAX. MAX. (LC)	MEMB.	FORCE (LBS)	MAX. MAX. (LC)	MEMB.
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 18	-91.8 -91.8	0.13 (1)	10.00	C-E	-502 0	0.12 (1)
B-G	-528 0	-109.0 -109.0	0.16 (4)	6.25	F-G	0 100	0.00 (1)
G-C	-418 0	-109.0 -109.0	0.23 (1)	6.25			
C-D	-19 0	-109.0 -109.0	0.23 (1)	6.25			
B-F	0 413	-18.5 -18.5	0.09 (1)	10.00			
F-E	0 413	-18.5 -18.5	0.18 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

GIRDER TYPE: CSld Girder
START DISTANCE = 0-0
START SPAN CARRIED = 3-0-0
END DISTANCE = 6-10-8
END SPAN CARRIED = 3-0-0
END WALL WIDTH = 4-8
APPLIED TO FRONT SIDE OF TOP CHORD.
- ADD'L LOADS BASED ON 55% OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.21")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.21")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.23/1.00 (C-G:1), BC=0.18/1.00 (E-F:1), WB=0.12/1.00 (C-E:1), SSI=0.19/1.00 (C-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
CDMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.36 (C) (INPUT = 0.90)
JSI METAL= 0.24 (C) (INPUT = 1.00)




Structural component only
DWG# T-2006874

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408038	J20	5	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 14:37:59 2020 Page 1
ID:DMCubINVR6TstFoe31v6I zns11-CaF2Z75k38XicZMNLBKe8mVQp QBiyHeqXwc3RzNUjs

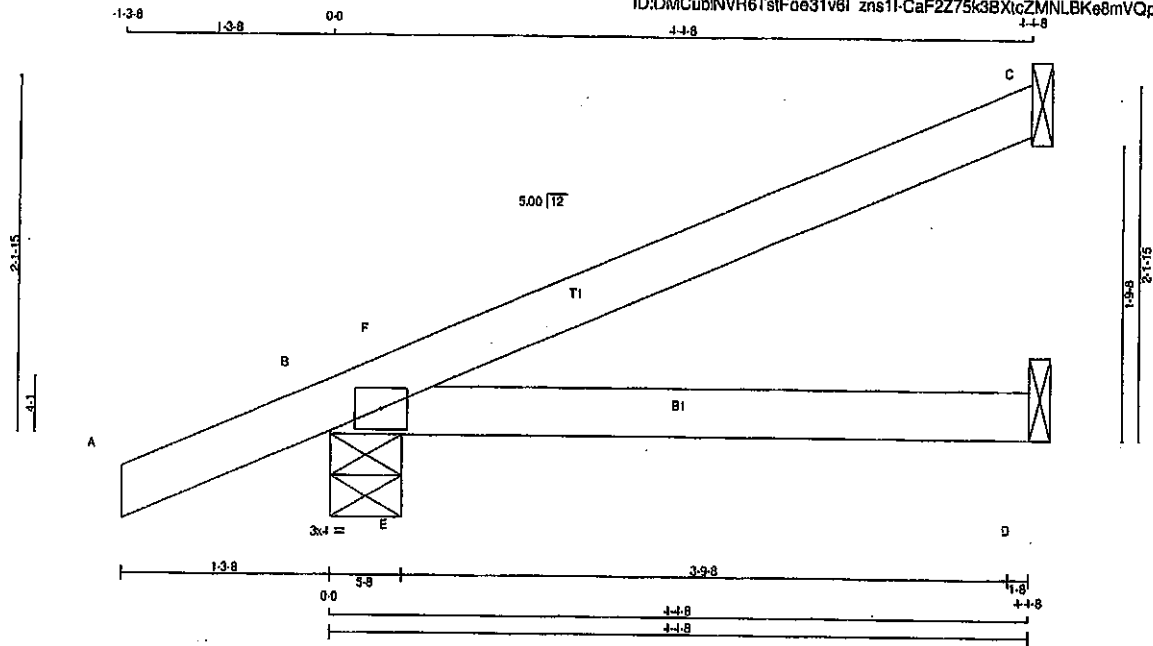

Scale = 1:13.4

LUMBER					
N. L. G. A. RULES					
CHORDS	SIZE	LUMBER	DESCR.	SPF	
A - C	2x4	DRY	No.2		
B - D	2x4	DRY	No.2		
DRY: SEASONED LUMBER.					

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
C	175	0	175	0	0	1-8	1-8	
B	365	0	365	0	0	5-8	5-8	
D	67	0	67	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

JT	1ST CASE		MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
C	121	94	0	0	0	27	0	
B	256	181	0	0	0	75	0	
D	50	18	0	0	0	32	0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED				WEBS			
	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX	MAX. UNBRACED LENGTH	FR-TO	MEMB.	MAX. FORCE (LBS)	MAX	CS1 (LC)
A-B	0 23	-91.8	-91.8	0.12 (1)	10.00		E-F	-235	7	0.00 (1)
B-F	-17 13	-91.8	-91.8	0.04 (4)	6.25					
F-C	-1 2	-91.8	-91.8	0.23 (1)	10.00					
B-E	0 0	-18.5	-18.5	0.16 (1)	10.00					
E-D	0 0	-18.5	-18.5	0.16 (1)	10.00					

TOTAL WEIGHT = 5 X 12 = 61 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSI: TC=0.23/1.00 (C-F:1), BC=0.16/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SS=0.19/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.26 (B) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)

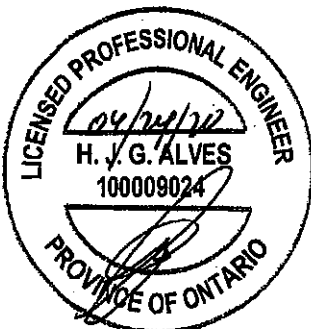


Structural component only
DWG# T-2006896

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408039	J45	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 14:59:38 2020 Page 1
ID:DMCubINVR6TstFoe31v6i zns11-gUF7CipY8IBZxC91xV7GhOOkonE92trX75s9ezNUPZ

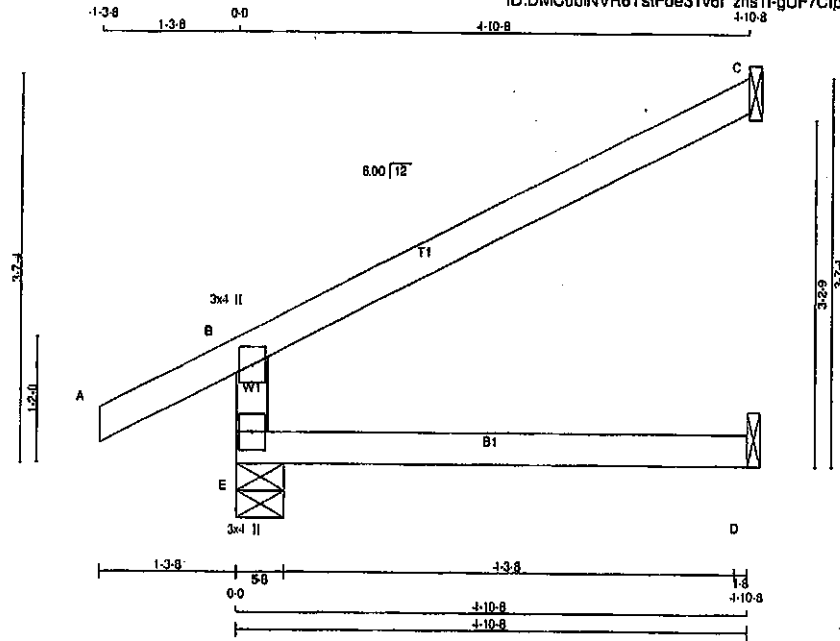

Scale = 1:20.5

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2	
A - C	2x4	DRY	No.2	
E - D	2x4	DRY	No.2	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
E	456	0	0	5-8
C	188	0	0	1-8
D	38	0	0	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
E	320	225 0	0 0	0 0	95 0	0 0
C	118	94 0	0 0	0 0	22 0	0 0
D	30	0 0	0 0	0 0	30 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRACED LENGTH	FR-TO	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
E-B	-404.0	0.0	0.0	0.08 (4)	7.81				
A-B	0.28	-91.8	-91.8	0.12 (1)	10.00				
B-C	-25.0	-91.8	-91.8	0.37 (1)	6.25				
E-D	0.0	-18.5	-18.5	0.09 (4)	10.00				

TOTAL WEIGHT = 14.5

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	39.0	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.02")

CSI: TC=0.37-1.00 (B-C:1), BC=0.09-1.00 (D-E:4), WB=0.00-1.00 (max:0), SS=0.20-1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788	1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.17 (E) (INPUT = 0.90)
JSI METAL = 0.11 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006926

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408016	C1	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 13:20:46 2020 Page 1
ID:DMCubINVR6TstF0e31v6l_zns11-MGpaCxC0c8hpFHagxRgiBtJ6h2OBvHBLTD8zyTzNVsF

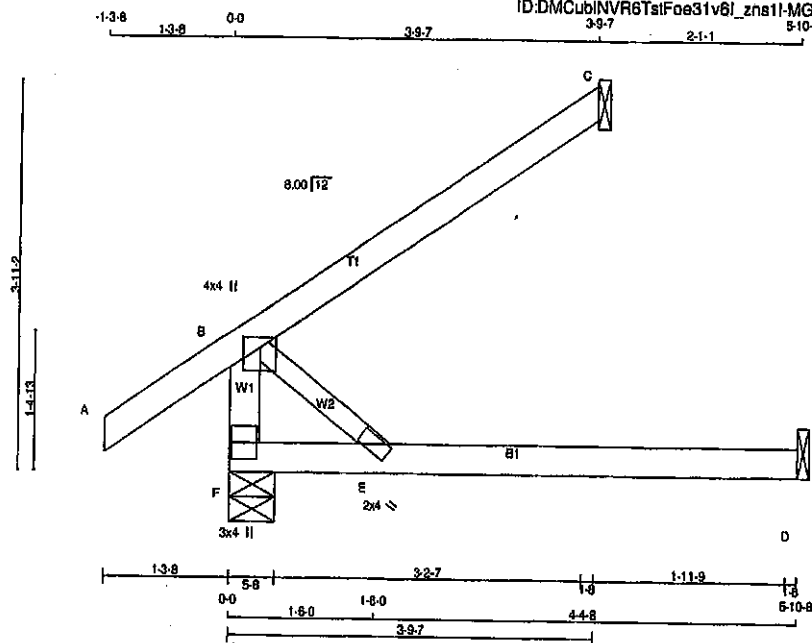

Scale = 1:22.5

LUMBER				
N. L. G. A. RULES	SIZE	LUMBER	DESCR.	
CHORDS			SPF	
F - B	2x4	DRY	No.2	
A - C	2x4	DRY	No.2	
F - D	2x4	DRY	No.2	
ALL WEBS	2x3	DRY	No.2	
DRY: SEASONED LUMBER.				

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMV+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
F	354	0	354	0	0	5-8	5-8	
C	174	0	174	0	0	1-8	1-8	
D	54	0	61	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	260	167.0	0.0	0.0	0.0	83.0	0.0
C	120	97.0	0.0	0.0	0.0	23.0	0.0
D	43	0.0	0.0	0.0	0.0	43.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO				FR-TO			
F-B	-300.0	0.0	0.03 (1)	B-E	0.0	0.00 (1)	
A-B	0.35	-91.8	-91.8 0.12 (1)				
B-C	0.0	-91.8	-91.8 0.22 (1)				
F-E	0.0	-18.5	-18.5 0.14 (4)				
E-D	0.0	-18.5	-18.5 0.19 (4)				

TOTAL WEIGHT = 2 X 16 = 32 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSI: TC=0.22/1.00 (B-C:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1887 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.21 (B) (INPUT = 0.90)
JSI METAL=0.06 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006946

JOB NAME 408016	TRUSS NAME C2	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRAWG NO.
Tamarack Roof Trusses, Burlington				TRUSS DESC.	

Version 8.310 S Oct 28 2019 Mitek Industries, Inc. Fri Apr 24 13:20:47 2020 Page 1
ID:DMCubINVR6TstFos31v6l_zns1l-qSNyPH1Ev?x6ukF8_ODQPzluKoX80ebritWVvzNVsE

Scale = 1:15.6

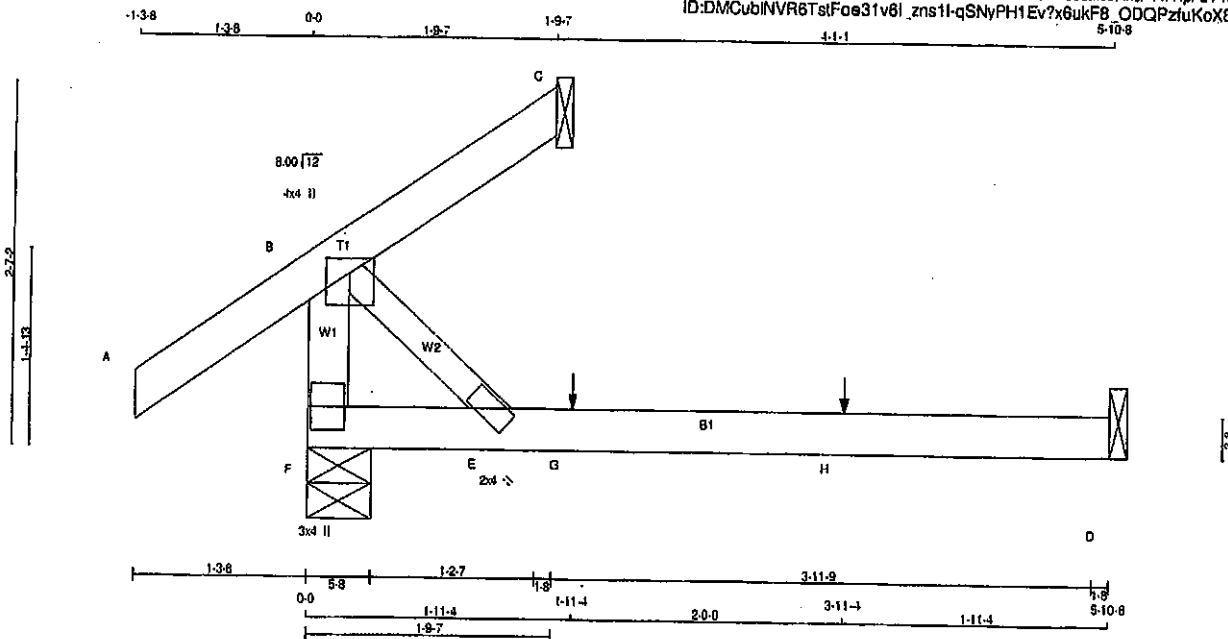

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMV+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
F	311	0	311	0	0	5-8	5-8	
C	34	0	34	0	0	1-8	1-8	
D	54	0	61	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE COMBINED		MAX. MIN. COMPONENT REACTIONS		PERM. LIVE	WIND	DEAD	SOIL
	SNOW	LIVE	SNOW	LIVE				
F	220	143.0	0.0	0.0	0.0	0.0	77.0	0.0
C	23	19.0	0.0	0.0	0.0	0.0	4.0	0.0
D	43	0.0	0.0	0.0	0.0	0.0	43.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS		MAX. FACTORED	
	FORCE (LBS)	VERT. LOAD LC1	MAX. (PLF)	MAX. (LC)	MEMB.	FORCE (LBS)	MAX. (LBS)	MAX. (LC)
FR-TO					FR-TO			
F-B	-256.0	0.0	0.0	0.03 (1)	B-E	0.0	0.00 (1)	
A-B	0.35	-91.8	-91.8	0.13 (1)				
B-C	-27.0	-91.8	-91.8	0.12 (1)				
F-E	0.0	-18.5	-18.5	0.13 (4)				
E-G	0.0	-18.5	-18.5	0.19 (4)				
G-H	0.0	-18.5	-18.5	0.19 (4)				
H-D	0.0	-18.5	-18.5	0.19 (4)				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	1-11-4	1	1	---	BACK	VERT	TOTAL	---	C1
H	3-11-4	1	1	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 13 = 27 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSI: TC=0.13/1.00 (A-B:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.09/1.00 (B-C:1)

DOL LUMBER=0.88 NAIL=0.98 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN
MT20	818	354	1667	788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006867

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408016	C3	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 13:20:48 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-leKdd2sgJ3zWuqKY5kfyAB0YBv115q7xXd41MzNVsD

Scale = 1:22.6

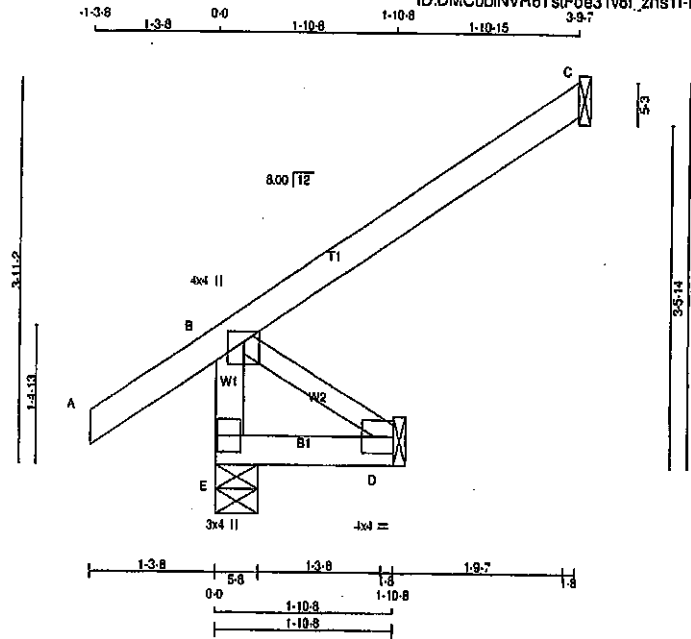

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
D	BMV1-i	MT20	4.0	4.0	2.00	Edge
E	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	316	0	316	0	5-8	5-8
C	174	0	174	0	1-8	1-8
D	16	0	18	0	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS					
		COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
E	219	167	0	0	0	0	0
C	120	97	0	0	0	23	0
D	13	0	0	0	0	13	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1		MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB. FR-TO	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
			FROM	TO					
E-B	-300	0	0.0	0.0	0.03 (1)	7.81	B-D	0	0.00 (1)
A-B	0	35	-91.8	-91.8	0.13 (5)	10.00			
B-C	0	0	-91.8	-91.8	0.22 (1)	10.00			
E-D	0	0	-18.5	-18.5	0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 12 = 24 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. O.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.22/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (B-D:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1687
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.21 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2006868

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408039	C46	4	1	GREEN PARK HOMES	
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 14:59:32 2020 Page 1
ID:DMCubINV6TslF0e31v6l_zns1l-rKtrxFknZSRQDHlaF0s2QYQJCjClK0y9Bexy_zNUPr

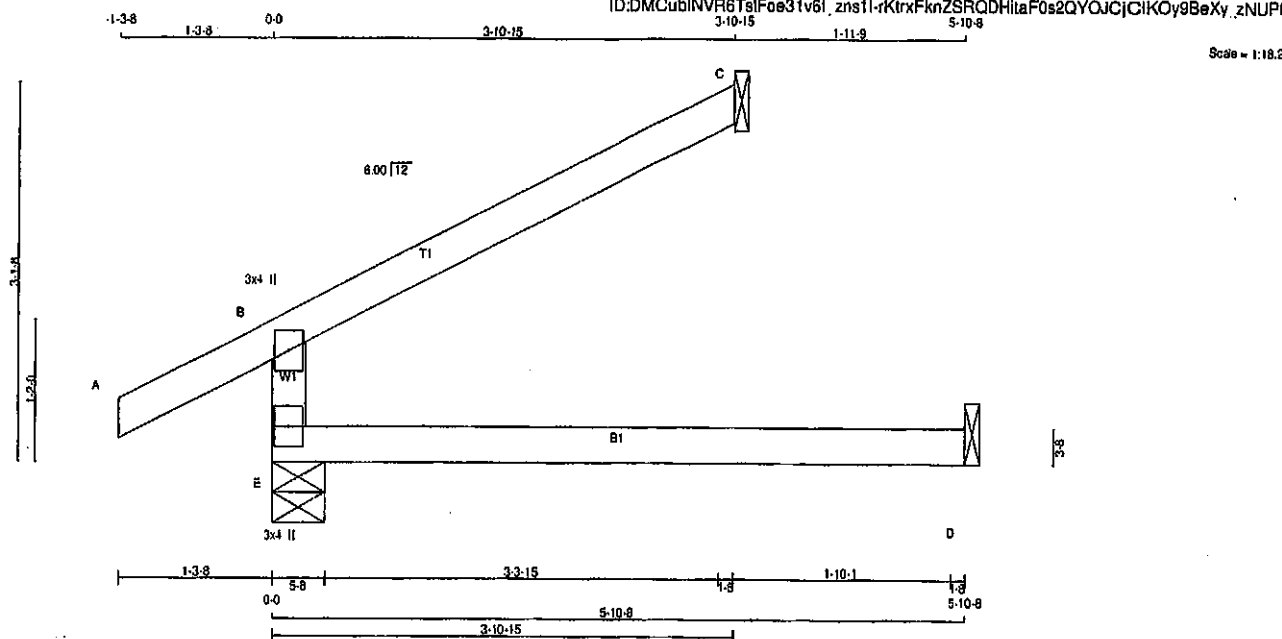

TOTAL WEIGHT = 4 X 14 = 57 lb

LUMBER		
N. L. G. A. RULES		
CHORDS	SIZE	LUMBER
E - B	2x4	DRY No.2
A - C	2x4	DRY No.2
E - D	2x4	DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	HORZ	BRG	IN-SX	BRG	IN-SX
E	412	0	412	0	0	5-8	5-8	5-8	5-8
C	135	0	135	0	0	1-8	1-8	1-8	1-8
D	45	0	50	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LOASE		MAX. MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
E	291	194	0	0	0	97	0	0	0
C	93	75	0	0	0	18	0	0	0
D	36	0	0	0	0	36	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		W E B S		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CS1 (LC)	UNBRAC	LENGTH	FORCE (LBS)	CS1 (LC)
FR-TO		FROM	TO		FR-TO		
E-B	-349	0	0.0	0.0	0.13 (4)	7.81	
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00	
B-C	-20	0	-91.8	-91.8	0.24 (1)	6.25	
E-D	0	0	-18.5	-18.5	0.13 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CS1: TC=0.24/1.00 (B-C:1), BC=0.13/1.00 (D-E:4),
WB=0.00/1.00 (n/a:0), SS1=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PS)	SECTION (PL)
MAX	MIN	MAX
MT20	618	354

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.15 (E) (INPUT = 0.90)
JSI METAL = 0.10 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006921

JOB NAME 408039	TRUSS NAME C47	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 24 14:59:33 2020 Page 1
 ID:DMCubINVR6TslFoe31v8l zns11-KWRE9aIPKmZHRCH38yX5be4Z3b5CUnd6OrN5URzNUPe
 Scale = 1:18.5

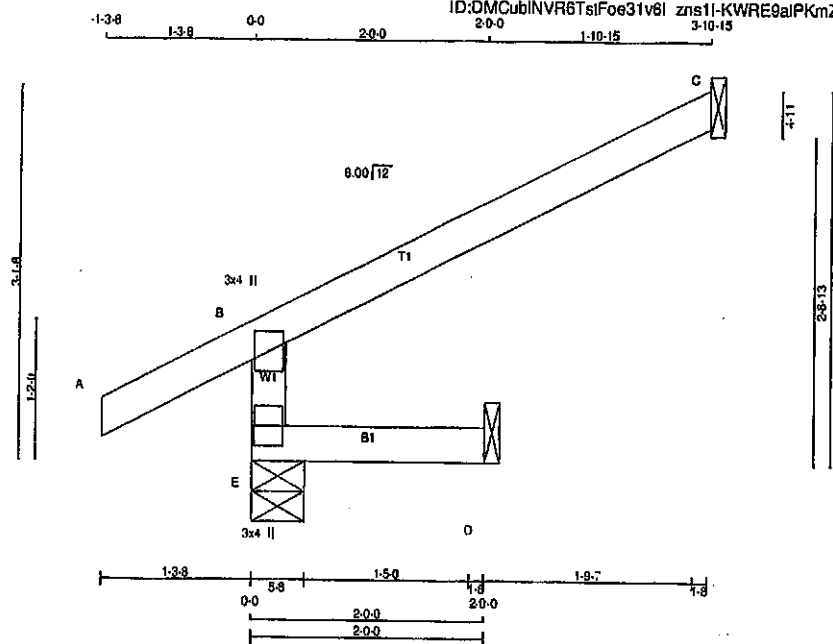

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DESCR. SPF
 SPF
 SPF

DRY, SEASONED LUMBER.

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	369	0	369	0	5-8	5-8	5-8
C	135	0	135	0	1-8	1-8	1-8
D	18	0	18	0	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		MAX. MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE
E	256	194.0	0.0
C	93	75.0	0.0
D	13	0.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (PLF)	MEMB.	MAX. FACTORED (LBS)
FR-TO				FR-TO	
E-B	-349	0	0.0	0.0	0.01 (4)
A-B	0	28	-91.8	-91.8	0.13 (5)
B-C	-20	0	-91.8	-91.8	0.24 (1)
E-D	0	0	-18.5	-18.5	0.02 (4)

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, CBC 2012, ABC 2019
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
 - OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
 ALLOWABLE DEFL.(TL) = L/360 (0.19")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.24/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (A-B:0), SSI=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1867 788 1867 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.15 (E) (INPUT = 0.90)
 JSI METAL = 0.10 (B) (INPUT = 1.00)



JOB NAME 408039	TRUSS NAME C48	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Fri Apr 24 14:59:34 2020 Page 1
ID:DMCubINVR6TstFos31v6l zns11-oj?cmWm154h8TasGif3K7rdm?R8DEIdV7e0zNUPd

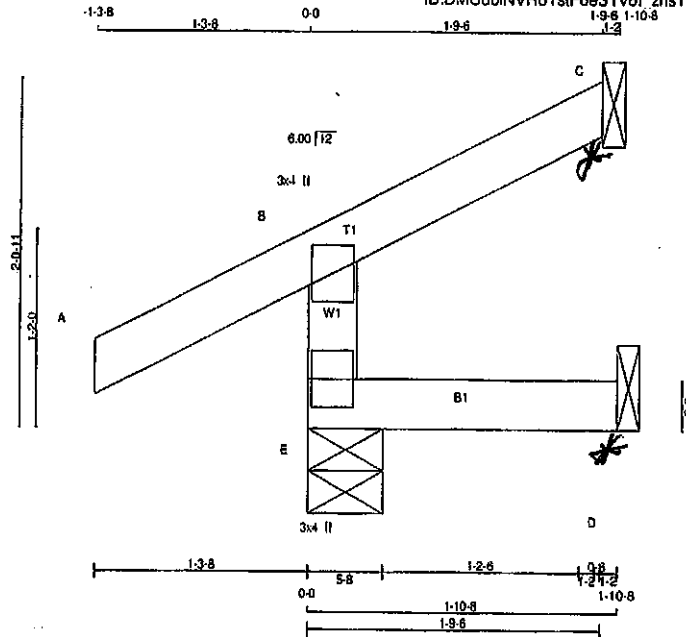

Scale = 1:13.1

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2		
A - C	2x4	DRY	No.2		
E - D	2x4	DRY	No.2		

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
E BMV1+p	MT20	3.0	4.0		

DESCR.
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
VERT	HORZ	DOWN	HORZ	UPLIFT
E	271	0	271	0
C	44	0	44	0
D	8	0	17	0

SEE MITTEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
COMBINED								
E	188	141	0	0	0	0	47	0
C	31	24	-18	0	0	0	7	0
D	7	0	-8	0	0	0	12	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (6)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC)	UNBRACED LENGTH	FR-TO
E-B	244	0	0.0	0.0	0.04 (5)	7.81	
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00	
B-C	-17	0	-91.8	-91.8	0.09 (1)	6.25	
E-D	0	0	-18.5	-18.5	0.04 (5)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 6 X 7 = 42 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, CBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5), WB=0.00/1.00 (A-D:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1857 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)


JSI METAL = 0.07 (B) (INPUT = 1.00)



Structural component only
DWG# T-2008923

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408039	C49	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri Apr 24 14:59:35 2020 Page 1
ID:DMCubiNVR6TstFoe31v6l_zns11-GvZ_ZGmgsNp 4kQSGNaZg3AvYPmXyh7Or9sBYJzNUPo

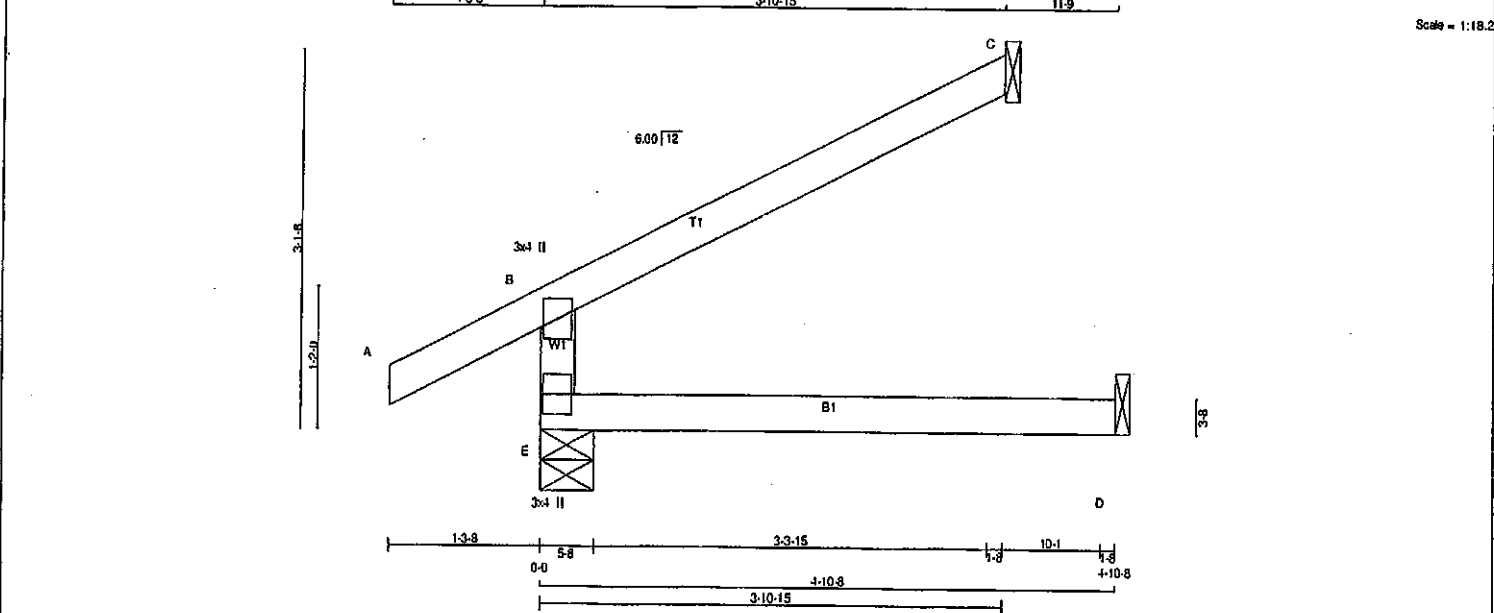

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	No.2
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY; SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
E	401 0	401 0	5-8	5-8
C	135 0	135 0	1-8	1-8
D	38 0	42 0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS
E	282	194 0 0 0 0 0 0 0 0 0 0
C	93	75 0 0 0 0 0 0 0 0 0 0
D	30	0 0 0 0 0 0 0 0 0 0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX	CS1 (LC)	UNBRAC LENGTH	FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)
E-B		-349 0	0.0	0.0	0.08 (4)	7.81					
A-B		0 28	-91.8	-91.8	0.12 (1)	10.00					
B-C		-20 0	-91.8	-91.8	0.24 (1)	6.25					
E-D		0 0	-18.5	-18.5	0.09 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CS1: TC=0.24/1.00 (B-C:1), BC=0.09/1.00 (D-E:4), WB=0.00/1.00 (wa:0), SS1=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(Psi) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.15 (E) (INPUT = 0.90)
JSI METAL = 0.10 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006924

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408039	C50	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Fri Apr 24 14:59:37 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1l-Chk_yowO73IK2agNoc1IUFHvDR?QbdhJTLIdCzNUPa

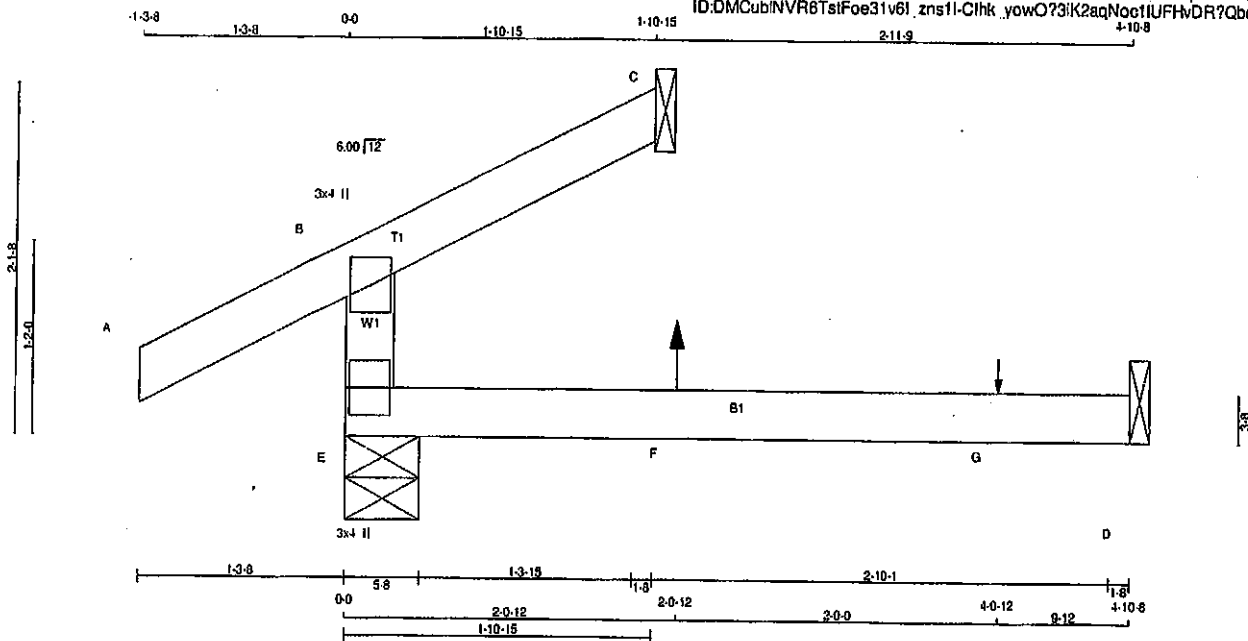

Scale = 1:13.4

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
E - B	2x4	No.2	SPF
A - C	2x4	DRY	SPF
E - D	2x4	DRY	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE				
B TMV+p	MT20	3.0	4.0	
E 8MV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	GROSS REACTION	DOWN	HORZ	DOWN	HORZ	UPLIFT	BRG	BRG	IN-SX
E	281	0	0	281	0	0	5-8	5-8	
C	66	0	0	66	0	0	1-8	1-8	
D	36	0	0	42	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST CASE		MAX. MIN. COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	DOWN	HORZ	DOWN	HORZ	DOWN	HORZ	DOWN	HORZ	DOWN	HORZ
E	200	127	0	0	0	0	0	0	0	73	0	0	0
C	46	37	0	0	0	0	0	0	0	9	0	0	0
D	29	0	-2	0	0	0	0	0	0	30	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (7)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)	MAX. FACTORED	CS1, LC1
FR-TO				FR-TO			
E-B	-234	0	0.0	0.0	0.08 (4)	7.81	
A-B	0	28	-91.8	-91.8	0.12 (1)	10.00	
B-C	-10	0	-91.8	-91.8	0.06 (1)	10.00	
E-F	0	0	-18.5	-18.5	0.09 (4)	10.00	
F-G	0	0	-18.5	-18.5	0.09 (4)	10.00	
G-D	0	0	-18.5	-18.5	0.09 (4)	10.00	

FACTORED CONCENTRATED LOADS (LBS)		FACE		DIR.		TYPE		HEEL		CONN.	
JT	LOC.	LOC1	MAX.	MAX+	FRONT	VERT	TOTAL	---	---	C1	C1
F	2-0-12	7	1	12	FRONT	VERT	TOTAL	---	---	C1	C1
G	4-0-12	1	1	---	FRONT	VERT	TOTAL	---	---	C1	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 11 = 21 lb [M]

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.02")

CS1: TC=0.12/1.00 (A-B:1), BC=0.09/1.00 (D-E:4), WB=0.00/1.00 (N/A:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)



Structural component only
DWG# T-2006925

LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1 1/4" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:

- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.




Double-Shear
Nailing
Top View




Double-Shear
Nailing
Side View;
Do not
bend tab




Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,580

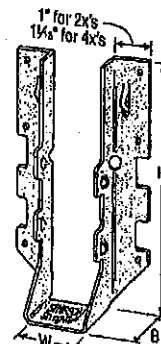


✓ LUS28




LU26L

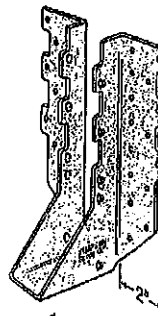

✓ HUS210
(HUS26, HUS28,
and HHUS similar)


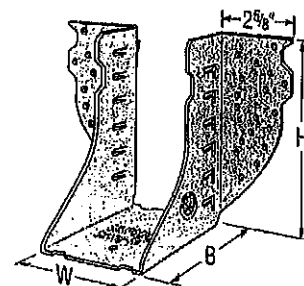


✓ HGUS28-2



✓ HHUS210-2

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

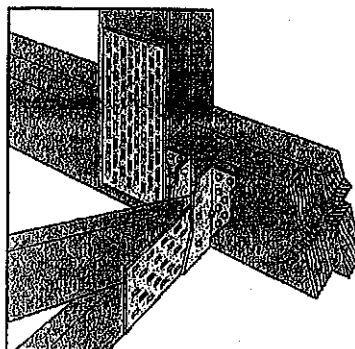

LJS26DS

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

HHUS/HGUS

See Hanger Options Information on pp. 125-127.


HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value

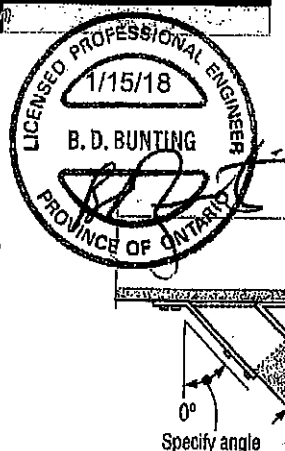

Top View HHUS Hanger
Skewed Right
(joist must be bevel cut)
All joist nails installed on the
outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (In.)				Fasteners		Factored Resistance							
		W	H	B	d _g ³	Header	Joist	D.Fir-L		S-P-F					
								Uplift	Normal	Uplift	Normal				
								(K _D = 1.15)	(K _D = 1.00)	(K _D = 1.15)	(K _D = 1.00)				
								lb.	lb.	lb.	lb.				
kN												kN	kN	kN	kN
Single 2x Sizes															
LUS24	18	1 1/8	3 1/2	1 1/4	2 1/4	(4) 10d	(2) 10d	710	1625	645	1155				
								3.16	7.23	2.87	5.14				
LU24L	22	1 1/8	3	1 1/4	2 1/4	(4) 10d	(2) 10d x 1 1/2"	360	1020	320	725				
								1.60	4.54	1.42	3.22				
LU26L	22	1 1/8	5	1 1/4	4 1/4	(6) 10d	(4) 10d x 1 1/2"	720	1606	645	1140				
								3.20	7.14	2.87	5.07				
LUS26	18	1 1/8	4 1/4	1 1/4	3 1/4	(4) 10d	(4) 10d	1420	2170	1290	1630				
								6.32	9.65	5.74	7.25				
HUS28	16	1 1/8	5 1/2	3	3 1/4	(14) 16d	(6) 16d	2705	4940	2085	3875				
								11.80	21.97	9.20	17.24				
LJS28DS	18	1 1/8	5	3 1/2	4 1/4	(16) 16d	(6) 16d	2055	4265	1480	4115				
								9.14	18.97	6.49	18.31				
HGUS26	12	1 1/8	5 1/2	5	4 1/4	(20) 16d	(8) 16d	2685	8625	2685	5700				
								11.88	29.51	11.96	25.35				
LU28L	20	1 1/8	6 1/4	1 1/4	5 1/4	(8) 10d	(8) 10d x 1 1/2"	1140	2185	1020	1550				
								5.07	9.72	4.54	6.89				
LUS28	18	1 1/8	6 1/4	1 1/4	3 1/4	(6) 10d	(4) 10d	1420	2520	1290	1790				
								6.32	11.21	5.74	7.96				
HUS28	16	1 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3605	5365	2675	4345				
								16.04	23.88	11.90	19.33				
HGUS28	12	1 1/8	7 1/4	5	6 1/8	(36) 16d	(12) 16d	3310	7675	3310	6900				
								14.74	34.19	14.74	30.73				
LU210L	20	1 1/8	8	1 1/4	7 1/4	(10) 10d	(6) 10d x 1 1/2"	1140	2495	1020	1770				
								5.07	11.10	4.54	7.87				
LUS210	18	1 1/8	7 1/8	1 1/4	3 1/4	(8) 10d	(4) 10d	1420	2785	1290	2210				
								6.32	12.39	5.74	9.83				

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_g is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27-28 for other nail sizes and information.

Face-Mount Hangers

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (In.)				Fasteners		Factored Resistance			
		W	H	B	d _g ³	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN	(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN
Double 2x Sizes											
LUS24-2	18	3 3/8	3 3/8	2	1 1/2	(4) 16d	(2) 16d	835	2020	590	1435
LUS26-2	18	3 3/8	4 3/8	2	4	(4) 16d	(4) 16d	3.71	8.99	2.62	6.38
								1720	2595	1545	1920
HHUS26-2	14	3 3/8	5 3/8	3	3 1/4	(14) 16d	(6) 16d	7.85	11.54	6.87	8.54
								2850	7335	2065	5205
HGUS26-2	12	3 3/8	5 3/8	4	4 1/4	(20) 16d	(8) 16d	12.68	32.63	9.20	23.15
								4385	8950	3110	6355
LUS28-2	18	3 3/8	7	2	4	(6) 16d	(4) 16d	19.51	39.81	13.83	28.27
								1720	3325	1545	2575
HHUS28-2	14	3 3/8	7 3/8	3	6 3/8	(22) 16d	(8) 16d	7.65	14.79	6.87	11.45
								3765	8940	2675	6345
HGUS28-2	12	3 3/8	7 3/8	4	8 3/8	(36) 16d	(12) 16d	16.75	39.77	11.90	28.22
								6070	12980	4310	9215
LUS210-2	18	3 3/8	9	2	6	(8) 16d	(6) 16d	27.00	57.74	19.17	40.99
								2580	4500	2320	3195
HHUS210-2	14	3 3/8	9 3/8	3	8	(30) 16d	(10) 16d	11.48	20.02	10.32	14.21
								4670	9600	4235	7000
HGUS210-2	12	3 3/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	29.77	42.97	18.84	31.14
								6840	14015	4855	10270
								30.43	62.34	21.60	45.69
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-3	12	4 1/8	7 1/8	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	4670	9670	4235	6865
								20.77	43.02	18.84	30.54
HGUS210-3	12	4 1/8	9 1/8	4	8 3/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.28
Quadruple 2x Sizes											
HGUS26-4	12	6 3/8	5 3/8	4	4 3/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
HGUS28-4	12	6 3/8	7 3/8	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
HHUS210-4	14	8 3/8	8 3/8	3	7 1/8	(30) 16d	(10) 16d	4670	10155	4235	7210
								20.77	46.17	18.84	32.07
HGUS210-4	12	6 3/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								30.43	65.14	21.60	46.26
HGUS212-4	12	6 3/8	10 3/8	4	10 3/8	(56) 16d	(20) 16d	7640	14995	5425	10645
								33.98	66.70	24.13	47.35
HGUS214-4	12	6 3/8	12 3/8	4	11 3/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80
4x Sizes											
LUS46	18	3 3/8	4 3/8	2	3 3/8	(4) 16d	(4) 16d	1720	2595	1545	1920
								7.65	11.54	6.87	8.64
HHUS46	14	3 3/8	5 3/8	3	3 1/4	(14) 16d	(6) 16d	2540	7335	2065	5205
								11.30	32.63	9.20	23.15
HGUS46	12	3 3/8	5 3/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								19.51	39.81	13.83	28.27
LUS48	18	3 3/8	6 3/8	2	3 3/8	(6) 16d	(4) 16d	1720	3325	1545	2575
								7.65	14.79	6.87	11.45
HHUS48	14	3 3/8	7 3/8	3	6 3/8	(22) 16d	(8) 16d	3765	8940	2675	6345
								16.75	39.77	11.90	28.22
HGUS48	12	3 3/8	7 3/8	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								27.00	57.74	19.17	40.99
LUS410	18	3 3/8	8 3/8	2	5 3/8	(8) 16d	(6) 16d	2580	4500	2320	3195
								11.48	20.02	10.32	14.21
HGUS410	12	3 3/8	9	4	8 3/8	(46) 16d	(16) 16d	4670	14015	4855	10270
								30.43	62.34	21.60	45.69
HGUS412	12	3 3/8	10 3/8	4	10 3/8	(56) 16d	(20) 16d	7640	14995	5425	10645
								33.98	66.70	24.13	47.35
HGUS414	12	3 3/8	12 3/8	4	11 3/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								45.06	72.95	32.00	51.80



Plated Truss Connectors

See footnotes on p. 258.

TC – Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1¼". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1½" = 0.148" dia. x 1½" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

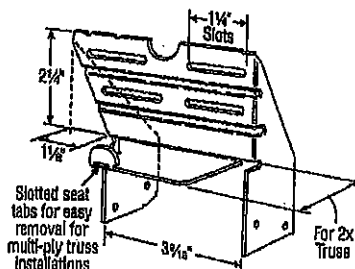


TC24
U.S. Patent 4,832,173

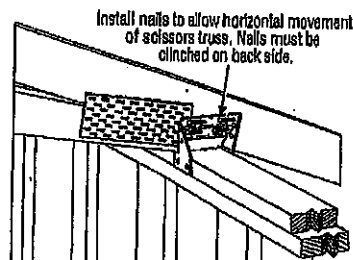


Typical TC24 installation

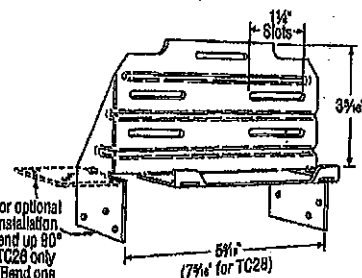

TC26
(TC28 Similar)

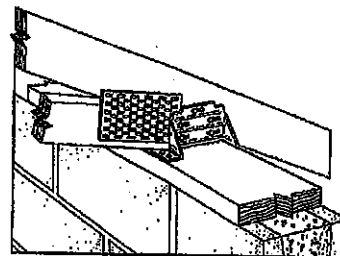

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer (8", 10", 12" Wall Installation Similar)

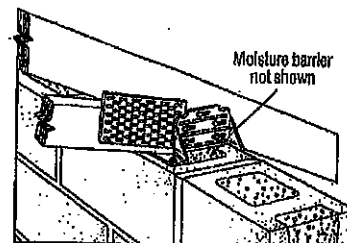

Optional TC26 Installation for Grouted Concrete Block using Titen Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift ($K_p=1.15$) lb.	Uplift ($K_p=1.15$) lb.
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift ($K_p=1.15$) lb.	Uplift ($K_p=1.15$) lb.
TC26	(5) 10d	(6) 10d x 1½"	810	660
	(5) 10d	(6) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.
2. Grout strength is 15 MPa minimum.
3. Optional TC26 installation with 10d nails requires minimum 3" top plate thickness.
4. TC26 fastened to grouted concrete block with (6) - ½" x 2¼" Titen screws has a factored uplift resistance of 275 lb.



SIMPSON
STRONG-TIE
DESIGN

© 2011 Simpson Strong-Tie Company
All rights reserved. Simpson Strong-Tie Company is a registered trademark of Simpson Strong-Tie Company.

U.S. Patent 4,832,173
U.S. Patent 4,832,173

(800) 999-5099
strongtie.com

H/TSP

SIMPSON
Strong-Tie

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance (K ₀ = 1.15)					
					D.Fir-L			S-P-F		
		To Rafters/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(5) 8d x 1½"	(4) 8d	—	740	685	300	680	485	216
SS H2A	18	(5) 8d x 1½"	(2) 8d x 1½"	(5) 8d x 1½"	830	220	75	590	155	55
SS H2.5A	18	(5) 8d	(5) 8d	—	3.69	0.98	0.33	2.62	0.69	0.24
H2.5T	18	(5) 8d	(5) 8d	—	805	160	160	755	160	160
SS H3	18	(4) 8d	(4) 8d	—	3.58	0.71	0.71	3.36	0.71	0.71
H6	16	—	(8) 8d	(8) 8d	835	175	210	740	160	210
H7Z	16	(4) 8d	(2) 8d	(8) 8d	3.71	0.78	0.93	3.29	0.71	0.93
SS H8 ^a	18	(5) 10d x 1½"	(5) 10d x 1½"	—	740	180	265	615	125	190
SS H10A ^a	18	(9) 10d x 1½"	(9) 10d x 1½"	—	3.29	0.80	1.18	2.74	0.56	0.85
H10AR	18	(9) 10d x 1½"	(9) 10d x 1½"	—	1585	1085	—	1125	770	—
H10A-2	18	(9) 10d x 1½"	(9) 10d x 1½"	—	7.05	4.83	—	5.00	3.43	—
H10S ^{a,b}	18	(8) 8d x 1½"	(8) 8d x 1½"	(8) 8d	1390	670	—	990	475	—
H11Z	18	(6) 16d x 2½"	(6) 16d x 2½"	—	6.18	2.98	—	4.40	2.11	—
H14	18	(1) (12) 8d x 1½"	(13) 8d	—	1120	—	—	1025	—	—
TSP	16	(9) 10d x 1½"	(6) 10d	—	4.98	—	—	4.56	—	—
		(2) (12) 8d x 1½"	(15) 8d	—	1735	795	410	1505	566	290
		(9) 10d x 1½"	(6) 10d x 1½"	—	7.72	3.54	1.82	6.69	2.51	1.29
		(9) 10d x 1½"	(6) 10d x 1½"	—	1485	690	430	1220	570	305
		(9) 10d x 1½"	(6) 10d x 1½"	—	6.61	3.07	1.91	5.43	2.54	1.36
		(9) 10d x 1½"	(6) 10d x 1½"	—	1835	1275	430	1645	880	305
		(9) 10d x 1½"	(6) 10d x 1½"	—	8.18	5.67	1.91	7.32	3.91	1.36
		(9) 10d x 1½"	(6) 10d x 1½"	—	1465	795	315	1040	566	225
		(9) 10d x 1½"	(6) 10d x 1½"	—	6.52	3.54	1.40	4.63	2.51	1.00
		(9) 10d x 1½"	(6) 10d x 1½"	—	1095	920	545	780	655	390
		(9) 10d x 1½"	(6) 10d x 1½"	—	4.87	4.09	2.42	3.47	2.91	1.73
		(9) 10d x 1½"	(6) 10d x 1½"	—	2390	855	320	1805	610	230
		(9) 10d x 1½"	(6) 10d x 1½"	—	10.63	3.80	1.42	8.03	2.71	1.02
		(9) 10d x 1½"	(6) 10d x 1½"	—	2390	855	320	1805	610	230
		(9) 10d x 1½"	(6) 10d x 1½"	—	10.63	3.80	1.42	8.03	2.71	1.02
		(9) 10d x 1½"	(6) 10d x 1½"	—	1295	440	—	920	310	—
		(9) 10d x 1½"	(6) 10d x 1½"	—	5.76	1.96	—	4.09	1.38	—
		(9) 10d x 1½"	(6) 10d x 1½"	—	1560	440	—	1105	310	—
		(9) 10d x 1½"	(6) 10d x 1½"	—	6.94	1.96	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2½" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 695 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1½" nails into the top plates and (3) 8d x 1½" nails into the lowest three flange holes into the truss bottom chord is 485 lb. (2.20 kN).
- Nails: 16d x 2½" = 0.162" dia. x 2½" long, 10d = 0.148" dia. x 3" long, 10d x 1½" = 0.148" dia. x 1½" long, 8d = 0.131" dia. x 2½" long, 8d x 1½" = 0.131" dia. x 1½" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

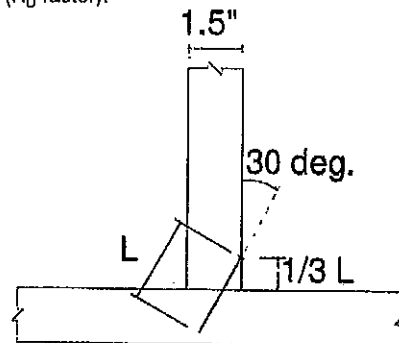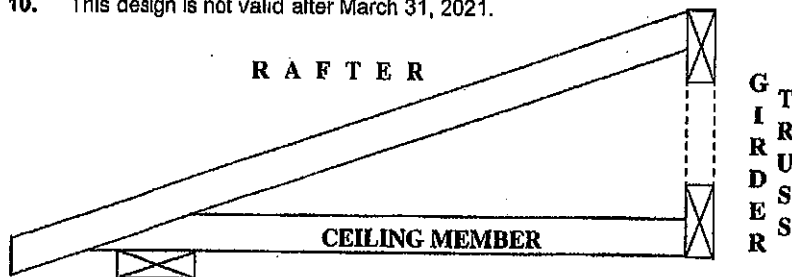

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (In)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.

Toe-nailing on 2x6 Bearing Plate

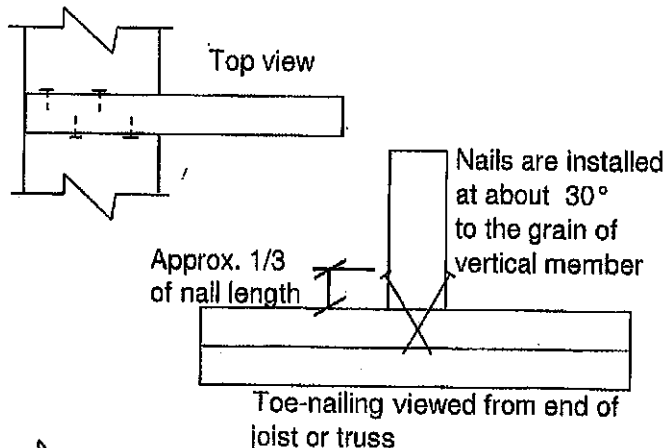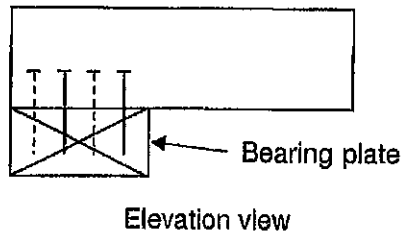

Toe-nailing on 2x4 Bearing Plate

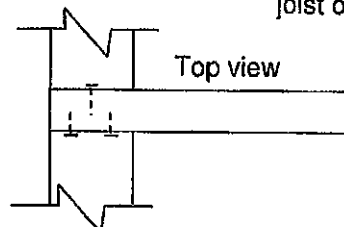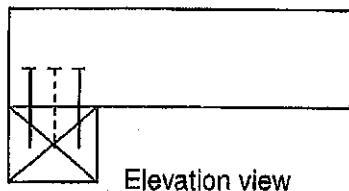

PEO
Certificate No. 10889485




MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7


December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-3/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

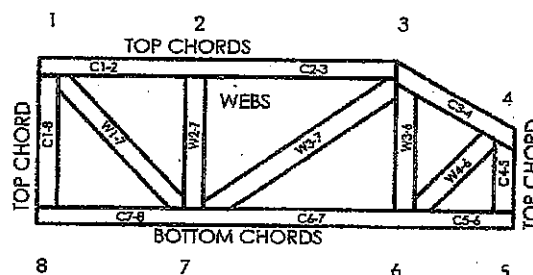

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L 10319-L 13270-L 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MIT-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

TECH-NOTES

ONTARIO WOOD TRUSS
FABRICATORS ASSOCIATION


TN 15-001 Piggyback Bracing

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

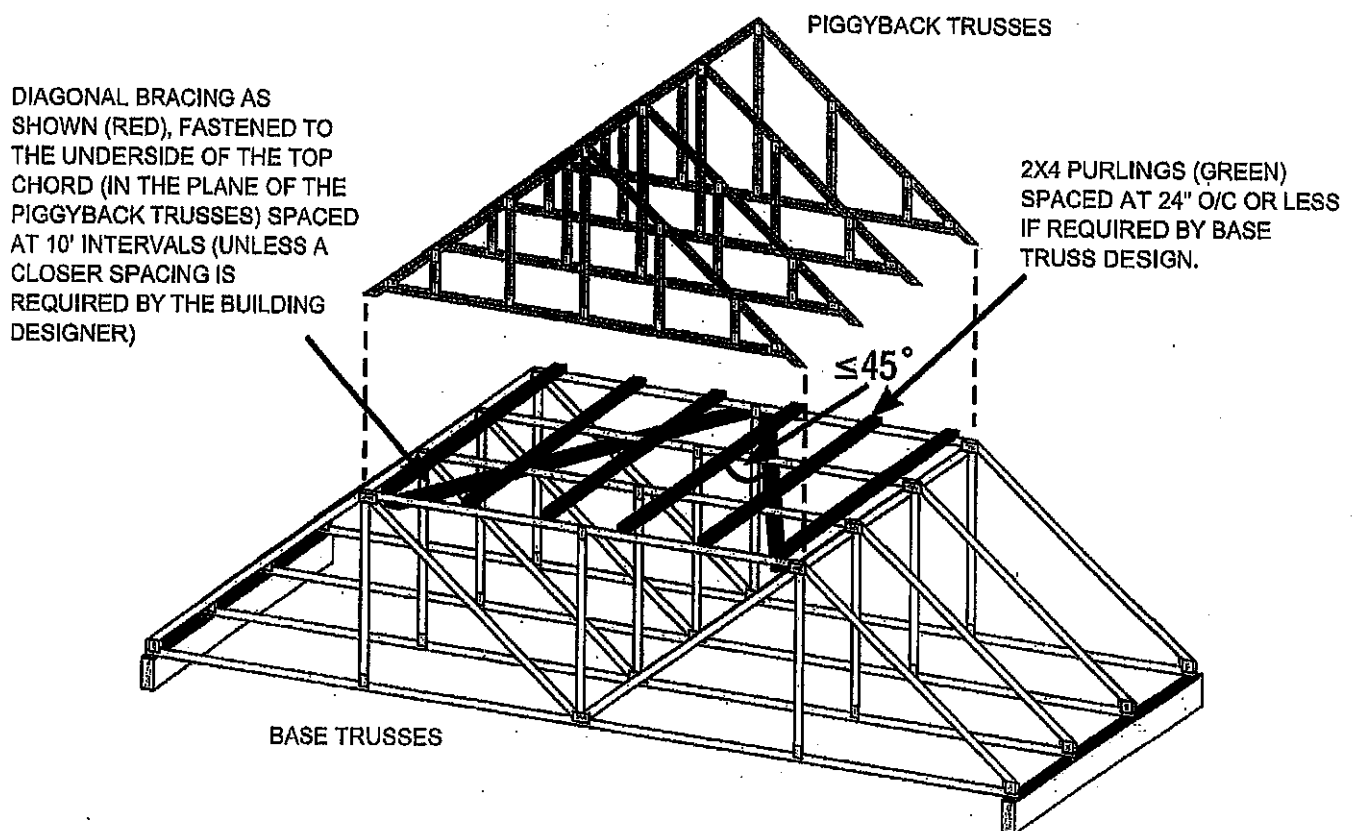

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1900218

Feb 09, 2018