
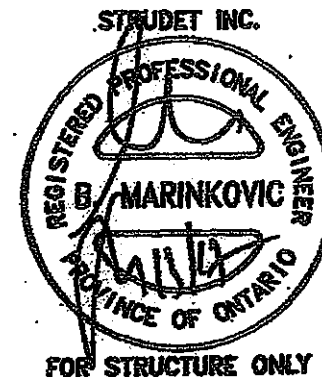


SECTION  
EXTERIOR WALKUP STAIRS DETAILS

### GENERAL NOTES:

- FOOTING**  
24"x8" POURED CONC. FOOTINGS. ALL FOOTINGS SHALL REST ON NATURAL UNDISTURBED SOIL OR COMPACTED GRANULAR FILL.
- CONCRETE**  
MINIMUM COMPRESSIVE STRENGTH OF 32 MPa (4650 psi) @ 28 DAYS. W/ 5% TO 8% AIR ENTRAINMENT.
- EXTERIOR STAIRS**  
7 1/8" RISE MAXIMUM  
8 1/4" RUN MINIMUM  
9 1/4" TREAD MINIMUM
- INSULATION**  
FOR INSULATION VALUE & VAPOUR BARRIER LOCATION REFER TO NOTE 15 OF STANDARD NOTES.
- RETAINING WALL**  
10" POURED CONCRETE W/ NO REINFORCING REQUIRED FOR WALL HEIGHTS TO A MAX. OF 4'-7". PROVIDE 15M VERTICAL REINFORCEMENT @ 16" O.C. AND 15M HORIZONTAL REINFORCEMENT @ 24" O.C. FOR WALL HEIGHTS FROM 4'-8" TO 7'-0". 15M HORIZONTAL & VERTICAL REINFORCEMENT @ 12" O.C. EACH FACE FOR WALL HEIGHTS FROM 7'-0" TO 9'-0". RETAINING WALL TO RESIST LATERAL DESIGN LOADS AS PER OBC DIVISION B SECTION 4.1.5.16.
- GUARDS**  
3'-6" HIGH WHERE DISTANCE FROM GRADE TO BOTTOM OF WALKOUT EXCEEDS 3'-11". 2'-11" FOR LESSER HEIGHTS. MAXIMUM 4" BETWEEN VERTICAL PICKETS.

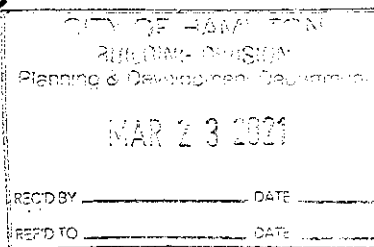

Region Design Inc.  
8700 Dufferin St.  
Concord, Ontario  
L4K 4S8  
(416) 736-4086  
fax (905) 880-0746



SHEET TITLE <b>WALK UP STAIR DETAIL</b>	
MODEL	LOT
DATE	SCALE 3/16"=1'
BY V.G.	AREA
PROJECT NO.	

Contractor shall check all dimensions and elevations before commencing with work and report any discrepancies to the designer. Prints are not to be scaled.



PROJECT:	PAGE NO. 1
----------	---------------