

FROM PLAN DATED:

BUILDER: GREEN PARK HOMES

SITE: RUSSELL GARDENS PH 3

MODEL: MOUNTAINASH 6

ELEVATION: 3

LOT: 257

CITY: WATERDOWN

SALESMAN: MARIO DICIANO

DESIGNER: AJ

REVISION:

NOTES:

REFER TO THE **NORDIC INSTALLATION GUIDE** FOR PROPER STORAGE AND INSTALLATION.

SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING CANT' OVER BRICK REI I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7, TABLES 1 & 2. **CERAMIC TIL** APPLICATION AS PER O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²


DEAD LOAD: 20.0 lb/ft²


SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 2020-04-16

1st FLOOR

DECK CONDITION

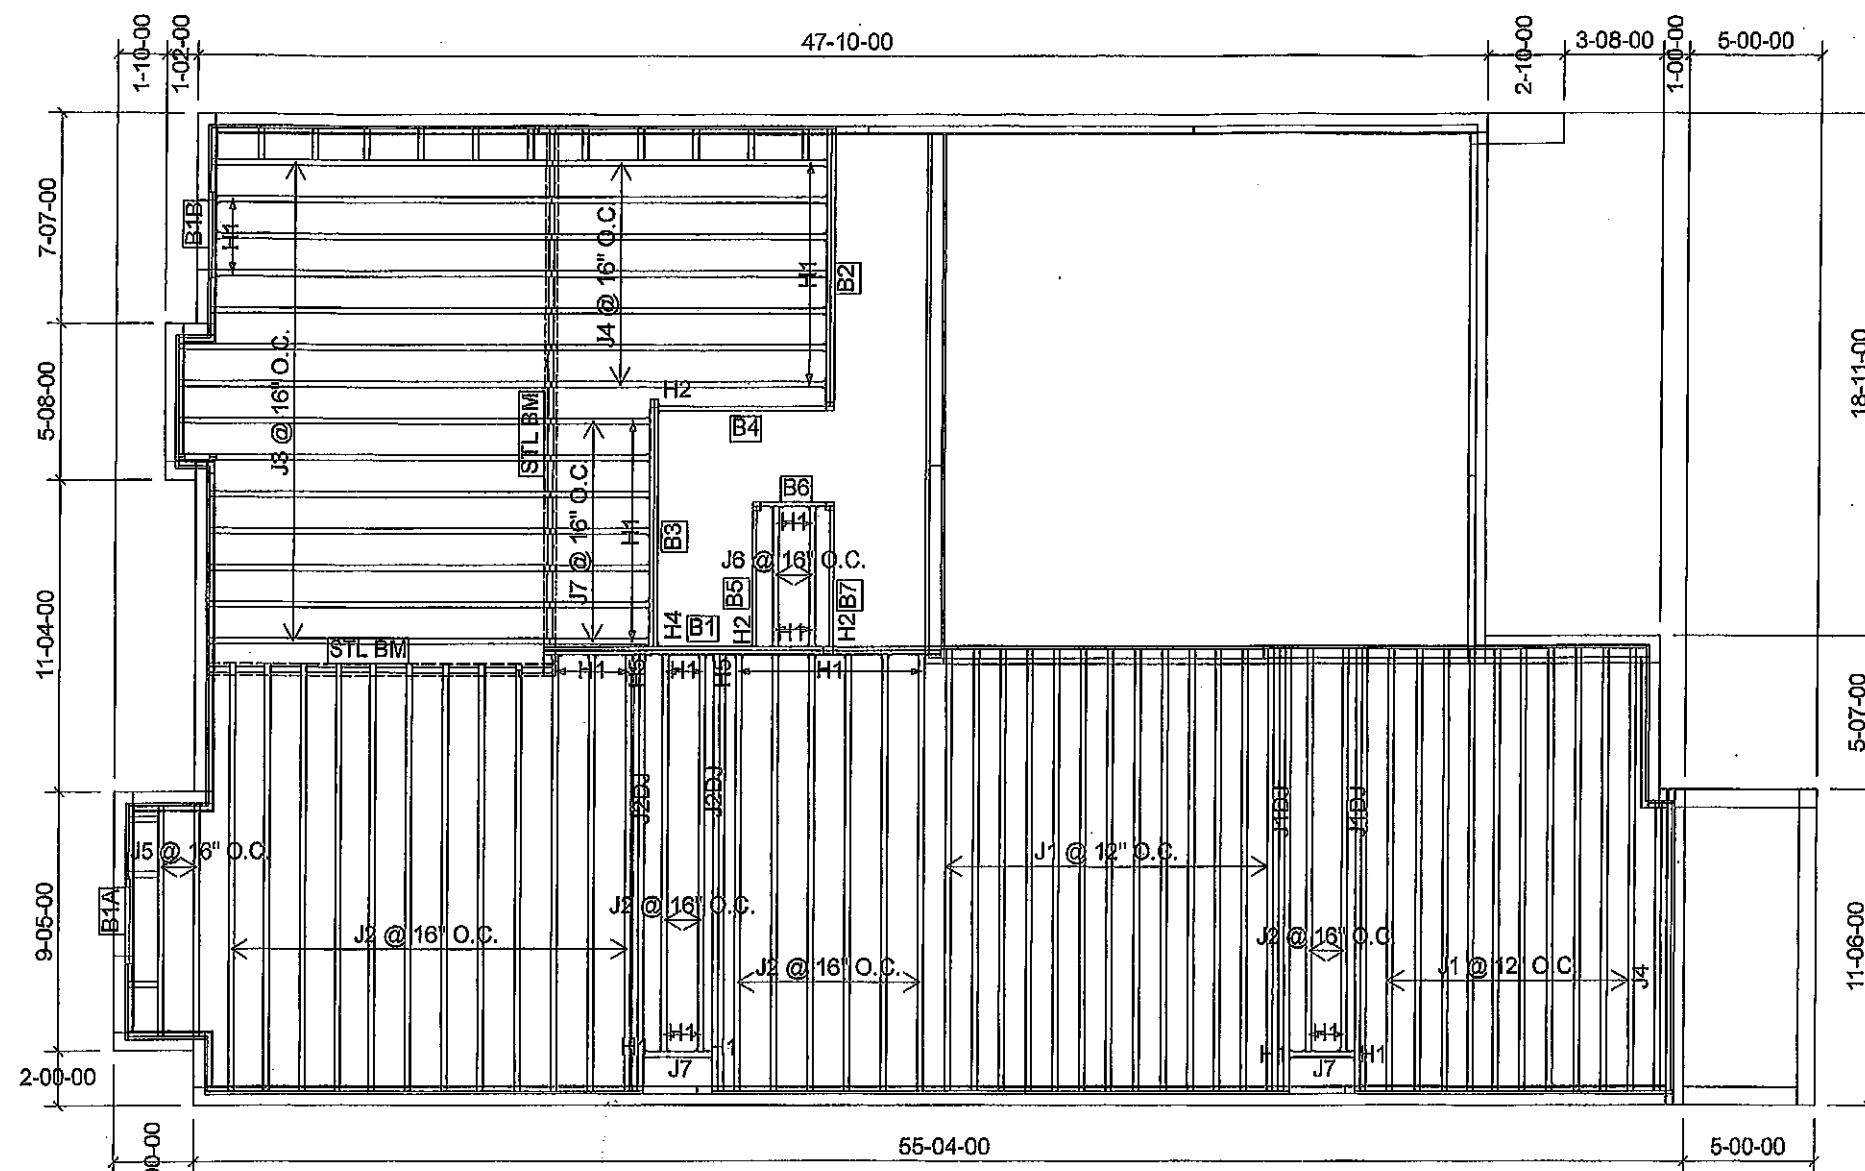

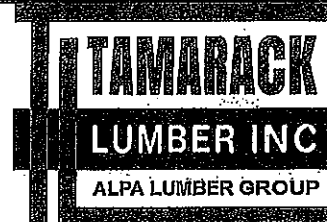

FROM PLAN DATED:
BUILDER: GREEN PARK HOMES
SITE: RUSSELL GARDENS PH 3
MODEL: MOUNTAINASH 6
ELEVATION: 3
LOT: 257
CITY: WATERDOWN
SALESMAN: MARIO DICIANO
DESIGNER: AJ
REVISION:


NOTES:
REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING CANT' OVER BRICK REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

LOADING:
DESIGN LOADS: L/480.000
LIVE LOAD: 40.0 lb/ft²
DEAD LOAD: 20.0 lb/ft²
SUBFLOOR: 5/8" GLUED AND NAILED

DATE: 2020-02-10


2nd FLOOR

OPT 5 BEDROOM

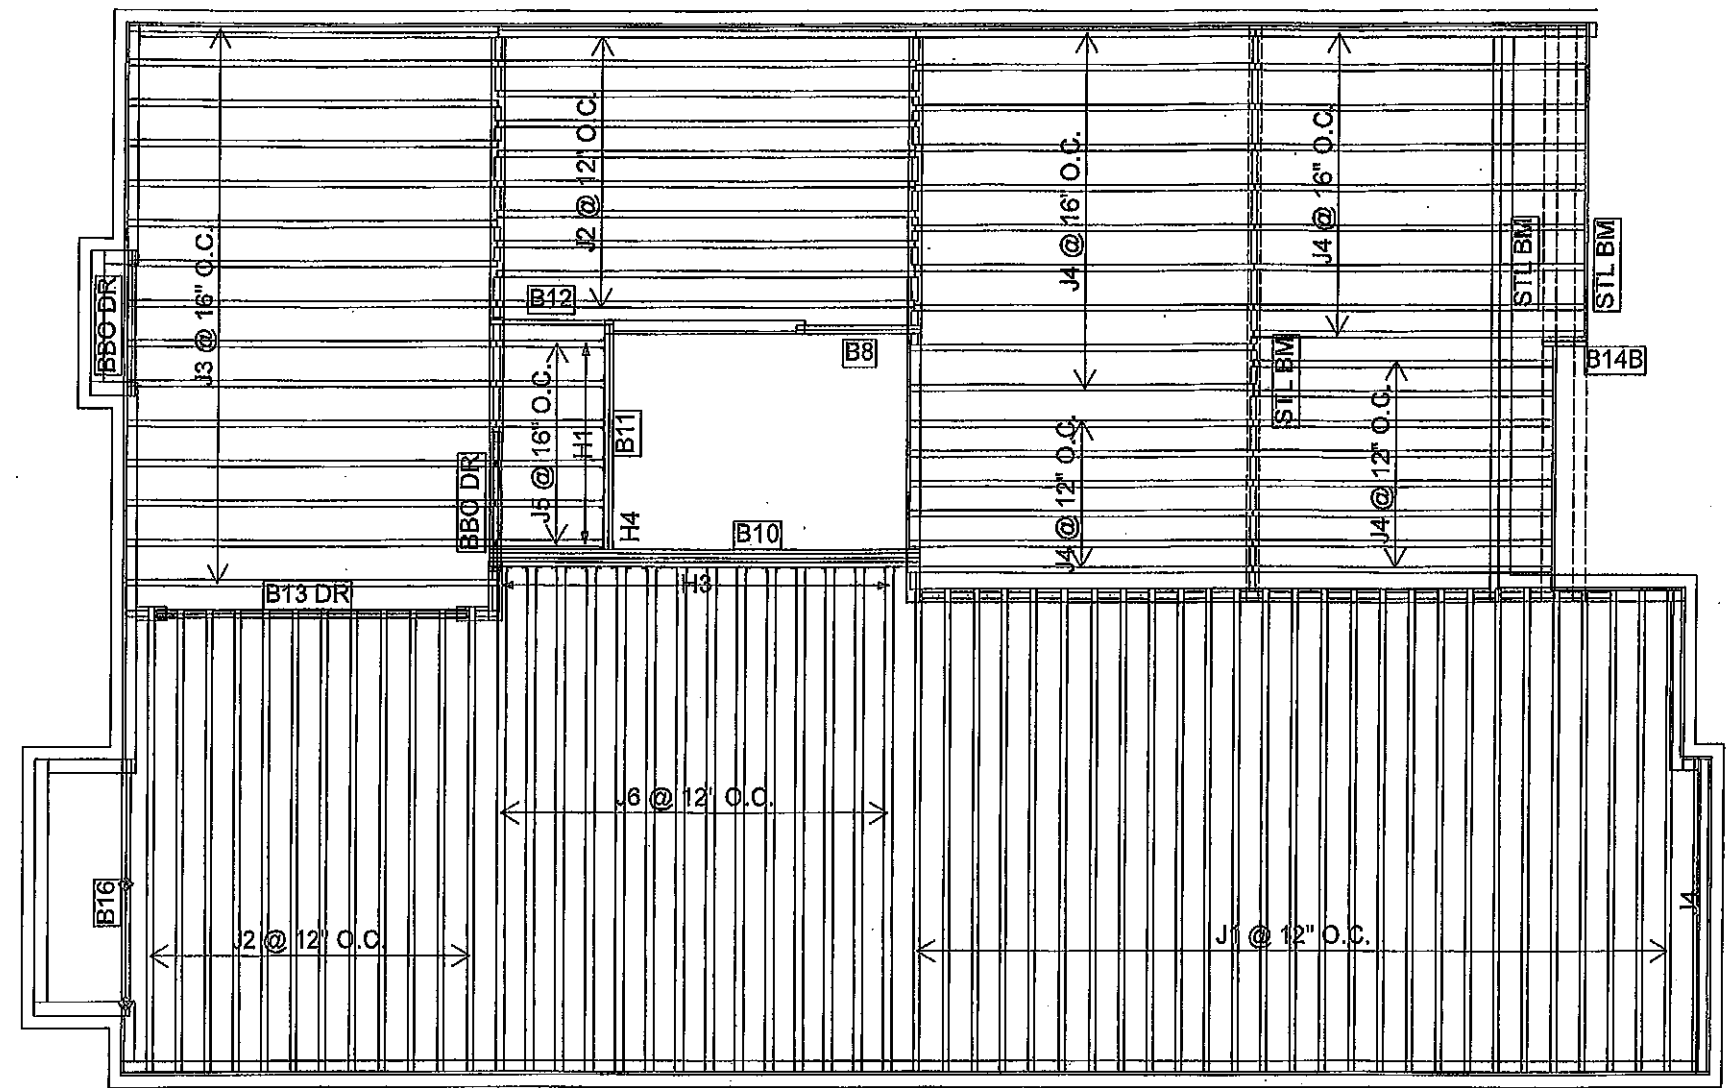

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
J1	18-00-00	9 1/2" NI-40x	1	27	MFD
J2	16-00-00	9 1/2" NI-40x	1	22	MFD
J3	14-00-00	9 1/2" NI-40x	1	15	MFD
J4	12-00-00	9 1/2" NI-40x	1	34	MFD
J5	4-00-00	9 1/2" NI-40x	1	6	MFD
J6	18-00-00	9 1/2" NI-80	1	14	MFD
B10	16-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	4	4	MFD
B13 DR	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B16	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B11	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B12	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1	MFD
B8	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD
B14B	2-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2	MFD

Connector Summary		
Qty	Manuf	Product
6	H1	IUS2.56/9.5
14	H3	IUS3.56/9.5
1	H4	HGUS410

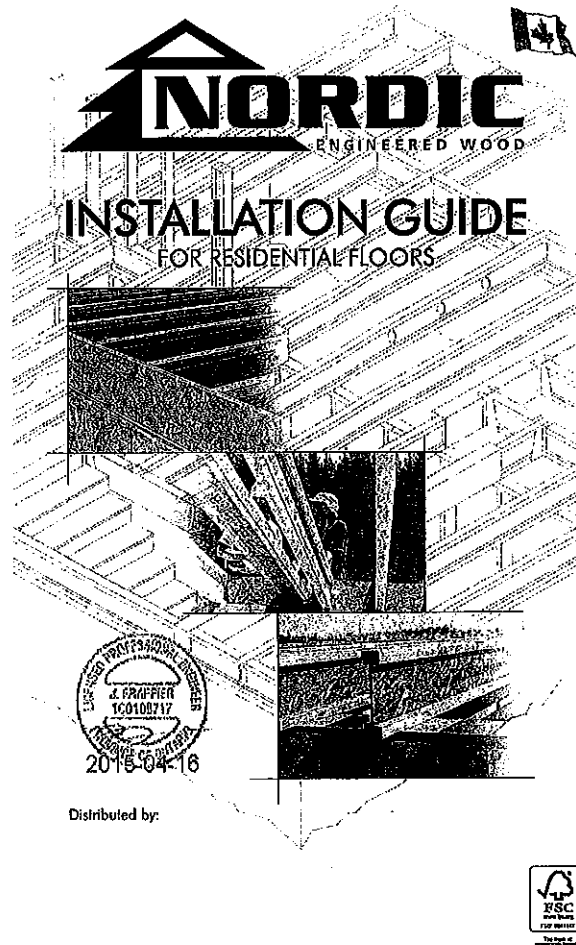

SAFETY AND CONSTRUCTION PRECAUTIONS



Do not walk on joists until fully fastened and braced, or serious injury can result.



Never stack building materials over unfastened joists. Once sheathed, do not over-stress joist with concentrated loads from building materials.

WARNING

Joists are not stable until completely installed, and will not carry any load until fully braced and sheathed.


Avoid Accidents by Following these Important Guidelines:

1. Brace and nail each joist as it is installed, using hangers, blocking panels, rim board, and/or cross-briding at joist ends. When joists are applied continuously over interior supports and a load-bearing wall is planned at that location, blocking will be required at the interior support.
2. When the building is completed, the floor sheathing will provide lateral support for the top flanges of the joists. Until this sheathing is applied, temporary bracing, when called for, or temporary sheathing must be applied to prevent joist rollover or buckling.
 - Temporary bracing or struts must be 1x4 inch minimum, at least 8 feet long and spaced no more than 8 feet on center, and must be secured with a minimum of two 2-1/2" nails fastened to the top surface of each joist. Nail the bracing to a lateral restraint at the end of each bay. Top ends of adjoining bracing over at least two joists.
 - Or, sheathing (temporary or permanent) can be nailed to the top flange of the first 4 feet of joists at the end of the bay.
3. For cantilevered joists, brace top and bottom flanges, and brace ends with dense panels, rim board, or cross-briding.
4. Install and fully nail permanent sheathing to each joist before placing loads on the floor system. Then, stack building materials over beams or walls only.
5. Never install a damaged joist.

Improper storage or installation, failure to follow applicable building codes, failure to follow span ratings for Nordic joists, failure to follow allowable hole sizes and locations, or failure to use web stiffeners when required can result in serious accidents. Follow these installation guidelines carefully.

STORAGE AND HANDLING GUIDELINES

1. Bundle wrap can be slippery when wet. Avoid walking on wrapped bundles.
2. Store, stack, and handle joists vertically and level only.
3. Always stack and handle joists in the upright position only.
4. Do not store joists in direct contact with the ground and/or flammable.
5. Protect joists from weather, and use spacers to separate bundles.
6. Bundled units should be kept intact until time of installation.
7. When handling joists with a crane on the job site, take a few simple precautions to prevent damage to the joists and injury to your work crew.
 - Pick joists in bundles as shipped by the supplier.
 - Orient the bundles so that the webs of the joists are vertical.
 - Pick the bundles at the 5th point, using a spreader bar if necessary.
8. Do not handle joists in a horizontal orientation.
9. NEVER USE OR TRY TO REPAIR A DAMAGED JOIST.



MAXIMUM FLOOR SPANS

1. Maximum clear spans applicable to single-span or multiple-span residential floor construction with a design load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration and a live load deflection limit of L/480. For multiple-span applications, the end spans shall be 40% or more of the adjacent span.
2. Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less, or 3/4 inch for joist spacing of 24 inches. Adhesive shall meet the requirements given in CBS-71.26 Standard. No concrete topping or bridging element was assumed. Increased spans may be achieved with the use of gypsum and/or a row of blocking at mid-span.
3. Minimum bearing length shall be 1-3/4 inches for the end bearings, and 3-1/2 inches for the intermediate bearings.
4. Bearing stiffeners are not required when joists are used with the spans and spacings given in this table, except as required for hangers.
5. This span chart is based on uniform loads. For applications with other than uniform loads, an engineering analysis may be required based on the use of the design properties.
6. Tables are based on Limit State Design per CAN/CSA C36-09 Standard, and NRC 2010.
7. SI units conversion: 1 inch = 25.4 mm, 1 foot = 0.305 m


MAXIMUM FLOOR SPANS FOR NORDIC I-JOISTS SINGLE AND MULTIPLE SPANS

Joist Depth	Joist Series	Simple spans				Multiple spans			
		On centre spacing				On centre spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NL-20	15'1"	14'2"	13'9"	13'3"	16'3"	15'4"	14'10"	14'7"
	NL-20S	16'1"	15'2"	14'8"	14'0"	17'3"	16'5"	15'10"	15'5"
	NL-20L	16'1"	15'4"	14'10"	14'11"	17'3"	16'7"	15'10"	15'11"
	NL-20H	17'1"	16'1"	15'6"	15'7"	18'3"	17'4"	16'9"	16'10"
11-7/8"	NL-22	16'1"	15'0"	14'5"	13'9"	16'10"	15'3"	14'9"	13'9"
	NL-22S	18'1"	17'0"	16'5"	16'6"	20'0"	18'6"	17'9"	17'7"
	NL-22L	18'1"	17'3"	16'7"	16'9"	20'3"	18'9"	18'0"	18'1"
	NL-22H	19'1"	18'0"	17'4"	17'5"	21'0"	19'11"	19'0"	19'1"
14"	NL-24	19'9"	18'3"	17'6"	17'7"	21'9"	20'2"	19'3"	19'4"
	NL-24S	20'2"	18'7"	17'10"	17'11"	22'3"	20'7"	19'8"	19'9"
	NL-24L	20'4"	18'9"	17'11"	17'11"	22'5"	20'9"	19'10"	19'11"
	NL-24H	20'5"	18'11"	18'1"	18'2"	22'7"	21'1"	20'0"	20'1"
16"	NL-26	21'7"	20'0"	19'1"	19'2"	23'10"	22'1"	21'1"	21'2"
	NL-26S	21'11"	20'5"	19'4"	19'5"	24'3"	22'5"	21'5"	21'6"
	NL-26L	22'5"	20'8"	19'9"	19'10"	24'9"	22'10"	21'10"	21'11"
	NL-26H	22'7"	20'11"	19'11"	19'11"	24'9"	22'1"	22'0"	22'1"
18"	NL-28	22'3"	20'8"	19'9"	19'10"	24'7"	22'9"	21'9"	21'10"
	NL-28S	21'11"	20'5"	19'4"	19'5"	24'0"	22'0"	21'1"	21'2"
	NL-28L	22'1"	21'1"	21'2"	21'2"	26'5"	24'5"	23'4"	23'4"
	NL-28H	22'5"	22'6"	21'5"	21'6"	26'11"	24'10"	23'9"	23'9"
20"	NL-30	22'9"	22'9"	21'9"	21'10"	27'5"	25'0"	24'0"	24'1"
	NL-30H	22'9"	22'9"	21'9"	21'10"	27'5"	25'0"	24'0"	24'1"

CCMC EVALUATION REPORT TABLE 10

I-JOIST HANGERS

1. Hangers shown illustrate the three most commonly used metal hangers to support I-joists.
2. All nailing must meet the hanger manufacturer's recommendation.
3. Hangers should be selected based on the joist depth, flange width and load capacity based on the maximum spans.
4. Web stiffeners are required when the sides of the hangers do not laterally brace the top flange of the joist.




WEB STIFFENERS

RECOMMENDATIONS:

- A bearing stiffener is required in all engineered applications with factored reactions greater than shown in the I-joist properties table found in the I-joist Construction Guide (C10). The gap between the stiffener and the flange is at the top.
- A bearing stiffener is required when the I-joist is supported in a hanger and the sides of the hanger do not extend up, and support, the top flange. The gap between the stiffener and flange is at the top.
- A load stiffener is required at locations where a factored concentrated load greater than 2,870 lbs is applied to the top flange between supports, or in the case of a cantilever, anywhere between the cantilever tip and the support. These values are for standard term load duration, and may be adjusted for other load durations as permitted by the code. The gap between the stiffener and the flange is at the bottom.

SI units conversion: 1 inch = 25.4 mm

FIGURE 2 WEB STIFFENER INSTALLATION DETAILS

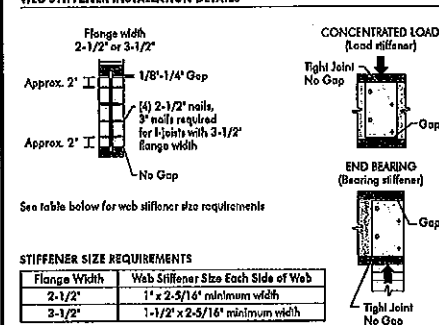


See table below for web stiffener size requirements

Flange Width	Web Stiffener Size Each Side of Web
2-1/2"	1" x 2-5/16" minimum width
3-1/2"	1-1/2" x 2-5/16" minimum width


INSTALLING NORDIC I-JOISTS

1. Before laying out floor system components, verify that joist flange widths match hanger widths. If not, consult supplier.
2. Except for cutting to length, joist flanges should never be cut, drilled, or notched.
3. Install joists so that top and bottom flanges are within 1/2 inch of true vertical alignment.
4. Joists must be anchored securely to supports before floor sheathing is attached, and supports for multiple-span joists must be level.
5. Minimum bearing lengths: 1-3/4 inches for end bearings and 3-1/2 inches for intermediate bearings.
6. When using hangers, seal joists firmly in hanger bottoms to minimize settlement.
7. Leave a 1/16-inch gap between the joist end and a header.
8. Concentrated loads greater than those that can normally be expected in residential construction should only be applied to the top surface of the top flange. Normal concentrated loads include track lighting fixtures, audio equipment and security cameras. Never suspend unusual or heavy loads from the joist's bottom flange. Whenever possible, suspend all concentrated loads from the top of the joist. Or, attach the load to blocking that has been securely fastened to the joist webs.
9. Never install joists where they will be permanently exposed to weather, or where they will remain in direct contact with concrete or masonry.
10. Restrain ends of floor joists to prevent rollover. Use rim board, rim joists or joist blocking panels.
11. For joists installed over and beneath bearing walls, use full depth blocking panels, rim board, or squash blocks (ripple members) to transfer gravity loads through the floor system to the wall or foundation below.
12. Due to shrinkage, common framing lumber set on edge may never be used as blocking or rim boards. Joist blocking panels or other engineered wood products - such as rim board - must be cut to fit between the joists, and on I-joist-compatible depth selected.
13. Provide permanent lateral support of the bottom flange of all joists at interior supports of multiple-span joists. Similarly, support the bottom flange of all cantilevered joists at the end support next to the cantilever extension. In the completed structure, the gypsum wallboard ceiling provides this lateral support. Until the final finished ceiling is applied, temporary bracing or struts must be used.
14. If square-edge panels are used, edges must be supported between joists with 2x4 blocking. Glue panels to blocking to minimize squeaks. Blocking is not required under structural finish flooring, such as wood strip flooring, or if a separate underlayment layer is installed.
15. Nail spacing: Space nails installed to the flange's top face in accordance with the applicable building code requirements or approved building plans.


FIGURE 1 TYPICAL NORDIC I-JOIST FLOOR FRAMING AND CONSTRUCTION DETAILS

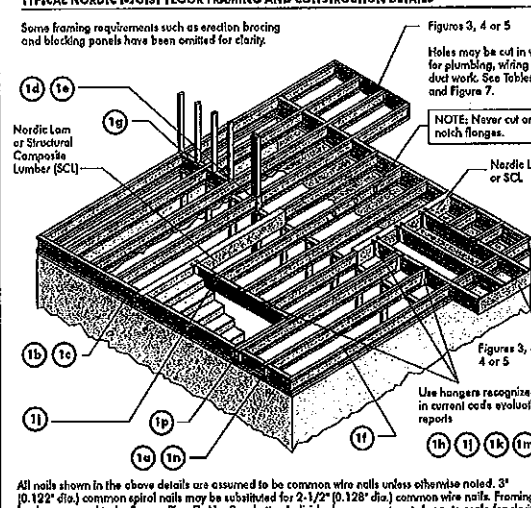


All nails shown in the above details are assumed to be common wire nails unless otherwise noted. 3" (122" dia.) common spiral nails may be substituted for 2-1/2" (64" dia.) common wire nails. Framing lumber assumed to be Spruce-Pine-Fir No. 2 or better. Individual components not shown to scale for clarity.

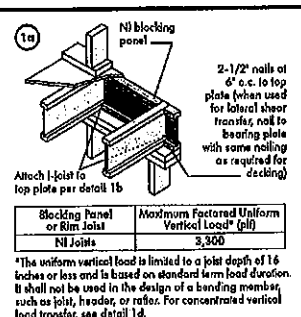


Blocking Panel or Rim Joist	Maximum Factored Uniform Vertical Load* (kN)
NL Joists	3,300

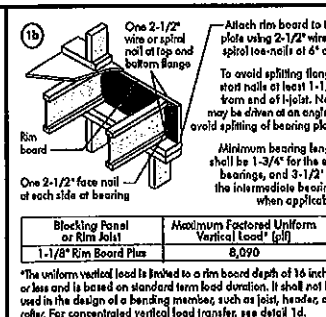


Blocking Panel or Rim Joist	Maximum Factored Uniform Vertical Load* (kN)
1-1/8" Rim Board Plus	8,090

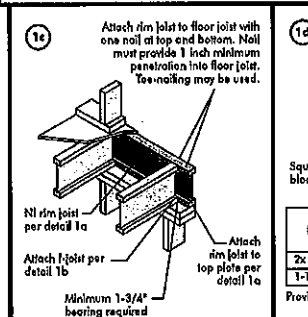


Pair of Squash Blocks	Maximum Factored Vertical per Pair of Squash Blocks (kN)
3-1/2" wide	5,500
5-1/2" wide	8,500
2x Lumber	4,300
1-1/8" Rim Board Plus	6,500

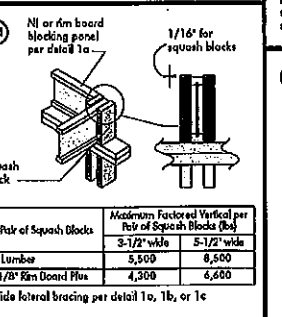


Pair of Squash Blocks	Maximum Factored Vertical per Pair of Squash Blocks (kN)
3-1/2" wide	5,500
5-1/2" wide	8,500
2x Lumber	4,300
1-1/8" Rim Board Plus	6,500

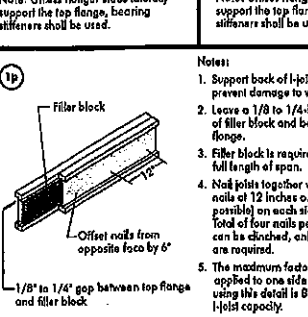


Pair of Squash Blocks	Maximum Factored Vertical per Pair of Squash Blocks (kN)
3-1/2" wide	5,500
5-1/2" wide	8,500
2x Lumber	4,300
1-1/8" Rim Board Plus	6,500

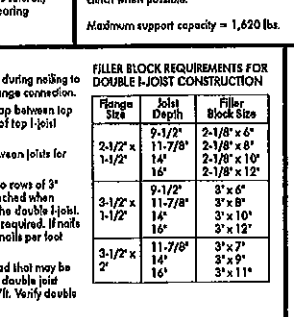

Pair of Squash Blocks	Maximum Factored Vertical per Pair of Squash Blocks (kN)
3-1/2" wide	5,500
5-1/2" wide	8,500
2x Lumber	4,300
1-1/8" Rim Board Plus	6,500

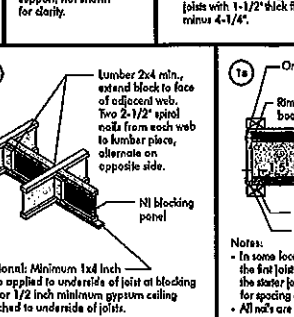


Pair of Squash Blocks	Maximum Factored Vertical per Pair of Squash Blocks (kN)
3-1/2" wide	5,500
5-1/2" wide	8,500
2x Lumber	4,300
1-1/8" Rim Board Plus	6,500

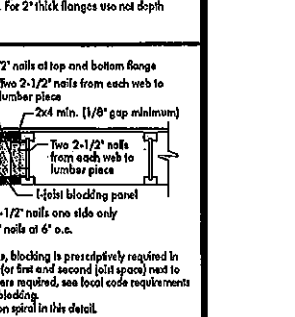


Pair of Squash Blocks	Maximum Factored Vertical per Pair of Squash Blocks (kN)
3-1/2" wide	5,500
5-1/2" wide	8,500
2x Lumber	4,300
1-1/8" Rim Board Plus	6,500

CANTILEVER DETAILS FOR BALCONIES (NO WALL LOAD)

2a) I-JOIST CANTILEVER DETAIL FOR BALCONIES (No Wall Load)

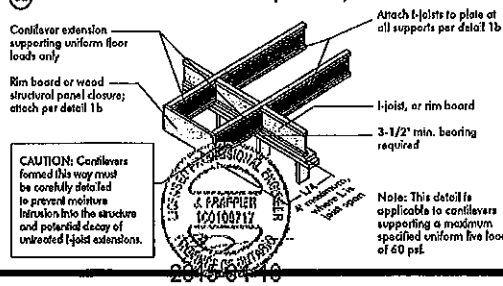


2b) LUMBER CANTILEVER DETAIL FOR BALCONIES (No Wall Load)

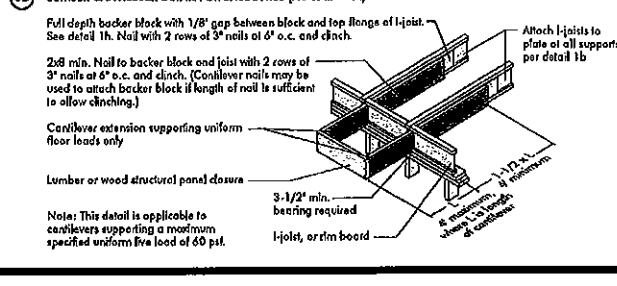


CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET (CONCENTRATED WALL LOAD)

2a) Method 1 — SHEATHING REINFORCEMENT ONE SIDE

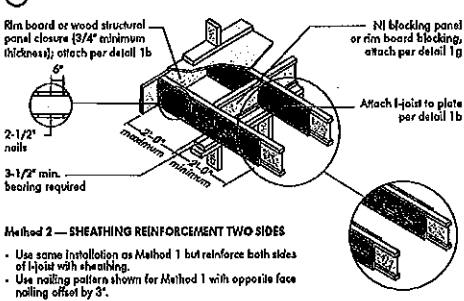

Method 2 — SHEATHING REINFORCEMENT TWO SIDES

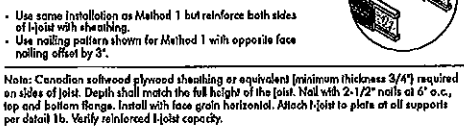

2b) Alternative Method 2 — DOUBLE I-JOIST


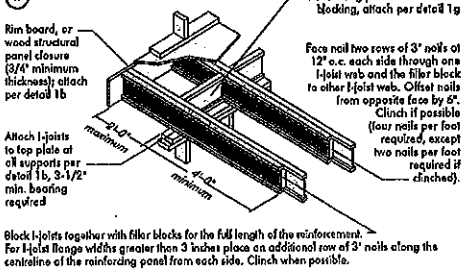


FIGURE 4 (continued)




CANTILEVER REINFORCEMENT METHODS ALLOWED

JOIST DEPTH (in.)	ROOF TRUSS SPAN (ft.)	LL = 30 psf, DL = 15 psf				LL = 40 psf, DL = 15 psf				LL = 60 psf, DL = 15 psf			
		12	16	19.2	24	12	16	19.2	24	12	16	19.2	24
9-1/2"	28	N	N	N	1	2	N	1	2	N	1	2	X
	30	N	N	N	1	2	N	1	2	N	1	2	X
	32	N	N	N	1	2	N	1	2	N	1	2	X
	34	N	N	N	1	2	N	1	2	N	1	2	X
11-7/8"	28	N	N	N	1	2	N	1	2	N	1	2	X
	30	N	N	N	1	2	N	1	2	N	1	2	X
	32	N	N	N	1	2	N	1	2	N	1	2	X
	34	N	N	N	1	2	N	1	2	N	1	2	X
14"	28	N	N	N	1	2	N	1	2	N	1	2	X
	30	N	N	N	1	2	N	1	2	N	1	2	X
	32	N	N	N	1	2	N	1	2	N	1	2	X
	34	N	N	N	1	2	N	1	2	N	1	2	X
16"	28	N	N	N	1	2	N	1	2	N	1	2	X
	30	N	N	N	1	2	N	1	2	N	1	2	X
	32	N	N	N	1	2	N	1	2	N	1	2	X
	34	N	N	N	1	2	N	1	2	N	1	2	X


1. N = No reinforcement required.
2. N = Reinforced with 3/4" wood structural panel on one side only.
3. N = Reinforced with 3/4" wood structural panel on both sides, or double I-joist.
4. For conventional roof construction using a ridge beam, the Roof Truss Span column above is equivalent to the distance between the supporting wall and the ridge beam. When the roof is framed using a ridge beam, the Roof Truss Span is equivalent to the distance between the supporting walls as if a truss is used.
5. Cantilevered joists supporting girder trusses or roof beams may require additional reinforcement.

BRICK CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET (CONCENTRATED WALL LOAD)

2a) SHEATHING REINFORCEMENT

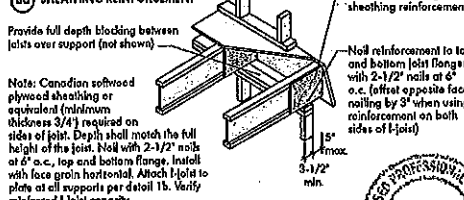

2b) SET-BACK DETAIL

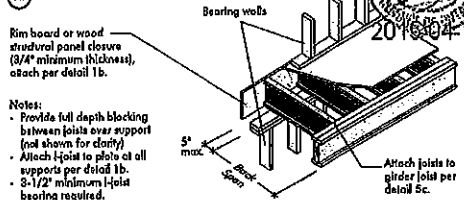

2c) SET-BACK CONNECTION


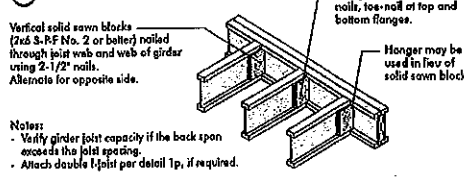


FIGURE 5 (continued)



BRICK CANTILEVER REINFORCEMENT METHODS ALLOWED

JOIST DEPTH (in.)	ROOF TRUSS SPAN (ft.)	LL = 30 psf, DL = 15 psf				LL = 40 psf, DL = 15 psf				LL = 60 psf, DL = 15 psf			
		12	16	19.2	24	12	16	19.2	24	12	16	19.2	24
9-1/2"	28	N	N	N	1	2	N	1	2	N	1	2	X
	30	N	N	N	1	2	N	1	2	N	1	2	X
	32	N	N	N	1	2	N	1	2	N	1	2	X
	34	N	N	N	1	2	N	1	2	N	1	2	X
11-7/8"	28	N	N	N	1	2	N	1	2	N	1	2	X
	30	N	N	N	1	2	N	1	2	N	1	2	X
	32	N	N	N	1	2	N	1	2	N	1	2	X
	34	N	N	N	1	2	N	1	2	N	1	2	X
14"	28	N	N	N	1	2	N	1	2	N	1	2	X
	30	N	N	N	1	2	N	1	2	N	1	2	X
	32	N	N	N	1	2	N	1	2	N	1	2	X
	34	N	N	N	1	2	N	1	2	N	1	2	X
16"	28	N	N	N	1	2	N	1	2	N	1	2	X
	30	N	N	N	1	2	N	1	2	N	1	2	X
	32	N	N	N	1	2	N	1	2	N	1	2	X
	34	N	N	N	1	2	N	1	2	N	1	2	X

1. N = No reinforcement required.
2. N = Reinforced with 3/4" wood structural panel on one side only.
3. N = Reinforced with 3/4" wood structural panel on both sides, or double I-joist.
4. For conventional roof construction using a ridge beam, the Roof Truss Span column above is equivalent to the distance between the supporting wall and the ridge beam. When the roof is framed using a ridge beam, the Roof Truss Span is equivalent to the distance between the supporting walls as if a truss is used.
5. Cantilevered joists supporting girder trusses or roof beams may require additional reinforcement.

WEB HOLES

RULES FOR CUTTING HOLES AND DUCT CHASE OPENINGS:

1. The distance between the inside edge of the support and the cantilever of any hole or duct chase opening shall be in compliance with the requirements of Table 1 or 2, respectively.
2. I-joist top and bottom flanges shall NEVER be cut, notched, or otherwise modified.
3. Whenever possible, field-cut holes should be centered on the middle of the web.
4. The maximum size hole or the maximum depth of a duct chase opening that can be cut into an I-joist web shall equal the clear distance between the flanges of the I-joist minus 1/4 inch. A minimum of 1/8 inch should always be maintained between the top or bottom of the hole or opening and the adjacent I-joist flange.
5. The sides of square holes or longer sides of rectangular holes shall not exceed 3/4 of the diameter of the maximum round hole permitted at that location.
6. Where more than one hole is necessary, the distance between adjacent holes shall exceed twice the diameter of the largest round hole or twice the size of the largest square hole (or twice the length of the longest side of the longest rectangular hole or duct chase opening) and each hole and duct chase opening shall be sized and located in compliance with the requirements of Tables 1 and 2, respectively.
7. A knockout is NOT considered a hole, may be utilized anywhere it occurs, and may be ignored for purposes of calculating minimum distances between holes and/or duct chase openings.
8. Holes measuring 1-1/2 inches or smaller shall be permitted anywhere in a cantilevered section of a joist. Holes of greater size may be permitted subject to verification.
9. A 1-1/2 inch hole or smaller can be placed anywhere in the web provided that it meets the requirements of rule number 6 above.
10. All holes and duct chase openings shall be cut in a workmanlike manner in accordance with the restrictions listed above and as illustrated in Figure 7.
11. Limit three maximum size holes per span, of which one may be a duct chase opening.
12. A group of round holes of approximately the same location shall be permitted if they meet the requirements for a single round hole circumscribed around them.

TABLE 1
LOCATION OF CIRCULAR HOLES IN JOIST WEBS
Simple or Multiple Span for Dead Loads up to 16 psf and Live Loads up to 40 psf

Joist Depth (in.)	Joist Series	Minimum distance from inside face of any support to centre of hole (ft.-in.)												Span Adjustment Factor
		8	10	12	14	16	18	20	22	24	26	28	30	
9-1/2"	11-1/2"	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9
	13-1/2"	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0
	15-1/2"	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	2.1
	17-1/2"	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	2.1	2.2
11-7/8"	13-7/8"	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0
	15-7/8"	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	2.1
	17-7/8"	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	2.1	2.2
	19-7/8"	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	2.1	2.2	2.3
14"	16-1/4"	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	2.1
	18-1/4"	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	2.1	2.2
	20-1/4"	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	2.1	2.2	2.3
	22-1/4"	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	2.1	2.2	2.3	2.4
16"	18-1/2"	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	2.1	2.2
	20-1/2"	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	2.1	2.2	2.3
	22-1/2"	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	2.1	2.2	2.3	2.4
	24-1/2"	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	2.1	2.2	2.3	2.4	2.5

1. Above table may be used for joist spacing of 24 inches on centre or less.

2. Hole location distance is measured from inside face of support to centre of hole.

3. Distances in this table are based on uniformly loaded joists.

OPTIONAL:

The above table is based on the I-joists used at their maximum span. If the I-joists are placed at less than their full maximum span (see Manufacturer's literature for details), the minimum distance from the cantilever of the hole to the face of any support (2) as given above may be reduced as follows:

Reduced = $\frac{\text{Actual Span}}{\text{Maximum Span}} \times \text{Table Value}$


Where:

- Reduced = Distance from the inside face of any support to centre of hole, reduced for less than maximum span application.
- Actual Span = The actual measured span distance between the inside faces of supports (ft.).
- Maximum Span = The maximum span distance between the inside faces of supports (ft.).
- Table Value = Span Adjustment Factor given in this table.

1. The minimum distance from the inside face of any support to centre of hole from this table.

2. If actual is greater than 1, use 1 in the above calculation for reduced.

FIGURE 7 FIELD-CUT HOLE LOCATOR

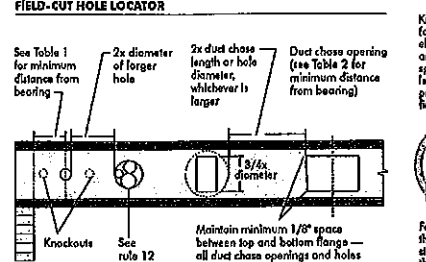

Knockouts are pre-cored holes provided for the contractor's convenience to install electrical or small plumbing lines. They are 1-1/2 inches in diameter and are spaced 15 inches on center along the length of the I-joist. Where possible, it is preferable to use knockouts instead of field-cut holes.

Never drill, cut or notch the flange, or over-cut the web.

Holes in webs should be cut with a sharp saw.

For rectangular holes, avoid over-cutting the corners, as this can cause unnecessary stress concentrations. Slightly rounding the corners is recommended. Starting the rectangular hole by drilling a 1-inch diameter hole in each of the four corners and then making the hole between the holes is another good method to minimize damage to the I-joist.

A knockout is NOT considered a hole, may be utilized wherever it occurs and may be ignored for purposes of calculating minimum distances between holes.

INSTALLING THE GLUED FLOOR SYSTEM

1. Wipe any mud, dirt, water, or ice from I-joist flanges before gluing.
2. Snap a chalk line across the I-joists four feet in from the wall for panel edge alignment and as a boundary for spreading glue.
3. Spread only enough glue to lay one or two panels at a time, or follow specific recommendations from the glue manufacturer.
4. Lay the first panel with tongue side to the wall, and nail in place. This protects the tongue of the next panel from damage when topped into place with a block and sledgehammer.
5. Apply a continuous line of glue (about 1/4-inch diameter) to the top flange of a single I-joist. Apply glue in a winding pattern on wide areas, such as with double I-joists.
6. Apply two lines of glue on I-joists where panel ends butt to ensure proper gluing of each end.
7. After the first row of panels is in place, spread glue in the groove of one or two panels at a time before laying the next row. Glue line may be continuous or spaced, but avoid squeeze-out by applying a thinner line (1/8 inch) then used on I-joist flanges.
8. Top the second row of panels into place, using a block to protect groove edges.
9. Stagger end joints in each succeeding row of panels. A 1/8-inch space between all end joints and 1/8-inch at all edges, including 18G edges, is recommended. (Use a spacer tool or on 2-1/2" common nail to ensure accurate and consistent spacing.)
10. Complete all nailing of each panel before glue sets. Check the manufacturer's recommendations for glue time. (When weather conditions are poor, use ring- or screw-shank nails for thicker panels. Space nails per the table below. Closer nail spacing may be required by some codes, or for diaphragm construction. The finished deck can be walked on right away and will carry construction loads without damage to the glue bond.

FASTENERS FOR SHEATHING AND SUBFLOORING(1)

Maximum Joist Spacing (in.)	Minimum Panel Thickness (in.)	Common V-Notch or Spaced Nails	Ring Shanks or Screws	Staples	Maximum Spacing of Fasteners (ft.)	Interior Supports
16	5/8"	2"	1-3/4"	2"	6'	12'
20	5/8"	2"	1-3/4"	2"	6'	12'
24	3/4"	2"	1-3/4"	2"	6'	12'

1. Fasteners of sheathing and subflooring shall conform to the above table.
2. Staples shall not be less than 1/16-inch in diameter or thickness, with not less than a 3/8-inch crown driven with the crown parallel to framing.
3. Flooring screws shall not be less than 1/8-inch in diameter.
4. Special conditions may impose heavy traffic and concentrated loads that require construction in excess of the minimums shown.
5. Use only adhesives conforming to CAN/CGSB-71.26 Standard, Adhesives for Field-Gluing Plywood to Lumber Framing for Floor System, applied in accordance with the manufacturer's recommendations. If OSB panels with sealed surfaces and edges are to be used, use only solvent-based glues; check with panel manufacturer.


Ref.: NRC-CNRC, National Building Code of Canada 2010, Table 9.23.3.5.

IMPORTANT NOTE:


Floor sheathing must be field glued to the I-joist flanges in order to achieve the maximum spans shown in this document. If sheathing is nailed only, I-joist spans must be verified with your local distributor.

RIM BOARD INSTALLATION DETAILS


2a) ATTACHMENT DETAILS WHERE RIM BOARDS ABUT

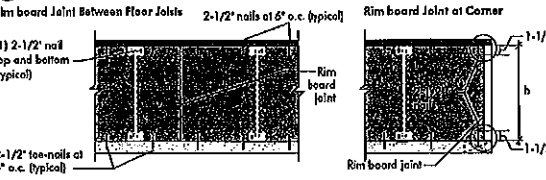

2b) TOE-NAIL CONNECTION AT RIM BOARD

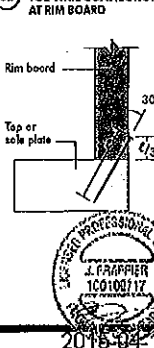

2c) 2X LEDGER TO RIM BOARD ATTACHMENT DETAIL

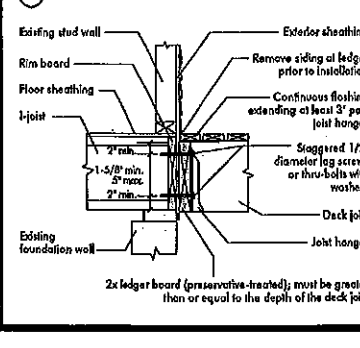

PRODUCT WARRANTY

Champion Chongram guarantees that, in accordance with our specifications, these products are free from manufacturing defects in material and workmanship.

Fluctuations, Champion Chongram reserves the right to modify our products, without notice, and we warrant our products against manufacturing defects in material and workmanship.

IMPORTANT NOTE: Floor sheathing must be field glued to the I-joist flanges in order to achieve the maximum spans shown in this document. If sheathing is nailed only, I-joist spans must be verified with your local distributor.



WEB HOLE SPECIFICATIONS

5. The sides of square holes or longest sides of rectangular holes should not exceed $3/4$ of the diameter of the minimum round hole permitted at that location.
6. Where more than one hole is necessary, the distance between adjacent hole edges shall exceed twice the diameter of the largest round hole or twice the side of the largest square hole (or twice the length of the longest side of the longest rectangular hole or duct chase opening), and each hole and duct chase opening shall be sized and located in compliance with the requirements of Tables 1 and 2, respectively.
7. A knockout is not considered a hole, may be utilized anywhere it occurs, and may be ignored for purposes of calculating minimum distances between holes and/or duct chase openings.
8. Holes measuring $1/16$ inches or smaller are permitted anywhere in a nonpressurized region of a listed, listed-in-place steel member, subject to verification.

9. A 1-1/2 inch hole or smaller can be placed anywhere in the wall provided that it meets the requirements of rule number 6 above.
10. All holes and duct chase openings shall be cut in a workman-like manner in accordance with the restrictions listed above and as illustrated in Figure 7.
11. Limit three maximum size holes per span, of which one may be a duct chase opening.
12. A group of round holes of approximately the same location shall be permitted if they meet the requirements for a single round hole circumscribed around them.

Jolt Depth	Jolt Series	Minimum Distance from Inside Face of Any Support to Centre of Hole (ft - in.)												
		Round Hole Diameter (in.)												
		2	3	4	5	6	6-1/4	8	8-5/8	9	10	10-3/4	11	12
9-1/2"	N1-20	0-7"	1-6"	2-10"	4-3"	5-8"	6-0"	---	---	---	---	---	---	---
	N1-40x	0-7"	1-6"	3-0"	4-4"	6-0"	6-4"	---	---	---	---	---	---	---
	N1-60	1-1"	2-6"	4-0"	5-4"	7-0"	7-5"	---	---	---	---	---	---	---
	N1-70	2-0"	3-4"	4-9"	6-3"	8-0"	8-4"	---	---	---	---	---	---	---
	N1-80	2-8"	3-6"	5-0"	6-4"	8-2"	8-8"	---	---	---	---	---	---	---
11-7/8"	N1-20	0-7"	0-8"	1-0"	2-4"	3-8"	4-0"	5-0"	6-6"	7-9"	---	---	---	---
	N1-40x	0-7"	0-8"	1-3"	2-8"	4-0"	4-4"	5-8"	7-0"	7-9"	---	---	---	---
	N1-60	0-7"	1-8"	3-0"	4-3"	5-8"	5-9"	8-10"	10-0"	10-0"	---	---	---	---
	N1-70	1-3"	2-0"	3-8"	5-0"	6-9"	7-2"	8-4"	10-1"	11-2"	---	---	---	---
	N1-80	1-6"	2-10"	4-2"	5-6"	7-0"	7-6"	8-6"	10-3"	11-4"	---	---	---	---
14"	N1-90	0-7"	0-8"	1-5"	3-2"	4-10"	5-4"	6-9"	8-9"	10-2"	---	---	---	---
	N1-90x	0-7"	0-8"	0-9"	2-6"	4-4"	4-9"	6-3"	---	---	---	---	---	---
	N1-40x	0-7"	0-8"	0-8"	1-0"	2-4"	2-9"	3-9"	5-2"	6-0"	6-8"	8-3"	10-2"	---
	N1-60	0-7"	0-8"	1-8"	3-0"	4-3"	4-8"	5-8"	6-8"	8-9"	10-4"	---	---	---
	N1-70	0-9"	1-0"	3-4"	4-4"	5-10"	5-8"	6-9"	8-9"	10-4"	12-0"	13-5"	---	---
16"	N1-80	2-10"	2-10"	4-4"	5-9"	7-5"	7-6"	9-0"	10-8"	12-3"	13-8"	---	---	---
	N1-90	0-7"	0-8"	1-0"	2-6"	4-0"	4-5"	5-9"	7-5"	8-8"	9-4"	11-4"	12-11"	---
	N1-90x	0-7"	0-8"	0-8"	2-0"	3-9"	4-2"	5-5"	7-3"	8-5"	9-2"	---	---	---
	N1-60	0-7"	0-8"	0-8"	1-6"	2-10"	3-2"	4-2"	5-8"	6-4"	7-0"	8-3"	9-8"	10-2"
	N1-70	0-7"	1-0"	2-3"	3-6"	4-10"	5-3"	6-3"	7-8"	9-2"	10-8"	12-0"	12-6"	13-0"
18"	N1-80	0-7"	1-3"	2-6"	3-10"	5-3"	5-8"	6-8"	8-0"	9-8"	11-0"	12-3"	14-8"	16-0"
	N1-90	0-7"	0-8"	0-8"	2-0"	3-3"	3-8"	4-8"	6-0"	7-5"	8-0"	10-1"	11-3"	13-9"
	N1-90x	0-7"	0-8"	0-8"	2-0"	3-6"	4-0"	5-0"	6-0"	7-0"	8-4"	10-2"	11-6"	12-0"
	N1-60	0-7"	0-8"	0-8"	1-6"	2-10"	3-2"	4-2"	5-8"	6-4"	7-0"	8-3"	9-8"	10-2"
	N1-70	0-7"	1-0"	2-3"	3-6"	4-10"	5-3"	6-3"	7-8"	9-2"	10-8"	12-0"	12-6"	13-0"

Jolt Depth	Jolt Series	Minimum distance from inside face of supports to centre of opening (ft. - in.)									
		Duct Chase Length (in.)									
		8	10	12	14	16	18	20	22	24	
9-1/2"	NJ-20	4'-1"	4'-5"	4'-10"	5'-4"	5'-8"	6'-1"	6'-6"	7'-1"	7'-5"	
	NJ-40x	5'-3"	5'-8"	6'-0"	6'-5"	6'-10"	7'-3"	7'-8"	8'-2"	8'-6"	
	NJ-60	5'-4"	5'-9"	6'-2"	6'-7"	7'-1"	7'-5"	8'-0"	8'-3"	8'-9"	
	NJ-70	5'-1"	5'-5"	5'-10"	6'-3"	6'-7"	7'-1"	7'-6"	8'-1"	8'-4"	
	NJ-80	5'-3"	5'-8"	6'-0"	6'-5"	6'-10"	7'-3"	7'-8"	8'-2"	8'-6"	
	NJ-90	5'-9"	6'-2"	6'-6"	7'-1"	7'-5"	7'-9"	8'-3"	8'-7"	9'-1"	
11-7/8"	NJ-40x	6'-6"	7'-2"	7'-6"	8'-1"	8'-6"	9'-1"	9'-6"	10'-1"	10'-6"	
	NJ-60	7'-3"	7'-9"	8'-0"	8'-6"	9'-0"	9'-3"	9'-9"	10'-3"	11'-0"	
	NJ-70	7'-1"	7'-4"	7'-9"	8'-3"	8'-7"	9'-1"	9'-6"	10'-1"	10'-4"	
	NJ-80	7'-2"	7'-7"	8'-0"	8'-5"	8'-9"	9'-3"	9'-8"	10'-2"	10'-7"	
	NJ-90	7'-6"	7'-11"	8'-4"	8'-9"	9'-2"	9'-7"	10'-1"	10'-6"	10'-11"	
	NJ-90x	7'-7"	8'-1"	8'-5"	8'-10"	9'-4"	9'-8"	10'-2"	10'-6"	11'-2"	
14"	NJ-40x	9'-1"	9'-7"	9'-9"	9'-6"	10'-1"	10'-7"	11'-1"	11'-6"	12'-0"	
	NJ-60	9'-9"	9'-5"	9'-8"	9'-5"	10'-0"	10'-6"	11'-0"	11'-5"	12'-0"	
	NJ-70	9'-7"	9'-7"	9'-9"	9'-9"	10'-4"	10'-8"	11'-2"	11'-7"	12'-3"	
	NJ-80	9'-0"	9'-3"	9'-9"	10'-1"	10'-7"	11'-1"	11'-6"	12'-1"	12'-6"	
	NJ-90	9'-2"	9'-8"	10'-0"	10'-6"	10'-11"	11'-5"	11'-9"	12'-4"	12'-11"	
	NJ-90x	9'-4"	9'-9"	10'-3"	10'-7"	11'-1"	11'-7"	12'-1"	12'-7"	13'-2"	
16"	NJ-40	10'-3"	10'-8"	11'-2"	11'-6"	12'-1"	12'-6"	13'-2"	13'-7"	14'-1"	
	NJ-70	10'-1"	10'-5"	11'-0"	11'-4"	11'-10"	12'-3"	12'-8"	13'-3"	14'-0"	
	NJ-80	10'-4"	10'-9"	11'-3"	11'-8"	12'-1"	12'-6"	13'-1"	13'-6"	14'-4"	
	NJ-90	10'-9"	11'-1"	11'-6"	12'-0"	12'-5"	13'-0"	13'-6"	14'-2"	14'-10"	
	NJ-90D	11'-3"	11'-5"	11'-10"	12'-4"	12'-10"	13'-2"	13'-9"	14'-4"	15'-2"	

1. Above table may be used for I-joist spacing of 24 inches on center or less.
2. Dead chord opening location distance is measured from inside face of supports to center of opening.
3. The above table is based on simple-span joists only. For other applications, contact your local distributor.
4. Distances are based on uniformly loaded floor joists that meet the span requirements for a design live load of 40 psf and dead load of 15 psf, and a live load deflection limit of 1/480.
5. The above table is based on the I-joists being used at their maximum spans. The minimum distance as given above may be reduced for shorter spans; contact your local distributor.

See Table 1 for minimum distance from bearing

2x diameter of larger hole

2x duct chase length or hole diameter, whichever is larger

Duct chase opening (see Table 2 for minimum distance from bearing)

Knockouts

See rule 12

3/4x diameter

Maintain minimum 1/8" space between top and bottom flange — all duct chase openings and holes

Knockouts are prestored holes provided for the contractor's convenience to install electrical or small plumbing lines. They are 1-1/2 inches in diameter, and are spaced 15 inches on center along the length of the joist. Where possible, it is preferable to use knockouts instead of field-cut holes.

Never drill, cut or notch the flange, or over-cut the web.

Holes in webs should be cut with a sharp saw.

For rectangular holes, avoid over-cutting the corners, as this can cause unnecessary stress concentrations. Slightly rounding the corners is recommended. Starting the rectangular hole by drilling a 1-inch diameter hole in each of the four corners and then making the cuts between the holes is another good method to minimize damage to the I-joint.

WARNING: Joists are not stable until completely installed, and will not carry any load until fully braced and sheathed.

1. Brace and nail each I-joint as it is installed, using hangers, blocking panels, rim board, and/or cross-bracing at joint ends. When I-joints are applied continuous over interior supports and a load-bearing wall is planned at that location, blocking will be required at the interior support.
2. When the building is completed, the floor sheathing will provide lateral support for the top flanges of the I-joints. Until this sheathing is applied, temporary bracing, often called struts, or temporary sheathing must be applied to prevent I-joint rollover or buckling.
 - Temporary bracing or struts must be 1x4 inch minimum, at least 8 feet long and spaced no more than 8 feet on centre, and must be secured with a minimum of two 2-1/2" nails fastened to the top surface of each I-joint. Nail the bracing to a lateral restraint at the end of each bay. Lap ends of adjoining bracing over at least two I-joints.
 - Or, sheathing (temporary or permanent) can be nailed to the top flange of the first 4 feet of I-joints at the end of the bay.
3. For cantilevered I-joints, brace top and bottom flanges, and brace ends with closure panels, rim board, or cross-briding.
4. Install and fully nail permanent sheathing to each I-joint before placing loads on the floor system. Then, stock building materials over beams or walls only.
5. Never install in domed I-joint.

* improper storage or installation, failure to follow applicable building codes, failure to follow span ratings for Nordic I-joists, failure to follow allowable hole sizes and locations, or failure to use web stiffeners when required can result in serious accidents. Follow these installation guidelines carefully.



Never stock building materials over unsheathed I-joists. Once sheathed, do not over-stress I-joists with concentrated load from building materials.



Charters Chibongaman guarantees that, in accordance with our specifications, Nordic products are free from manufacturing defects in material and workmanship.

Furthermore, Chautlers Chibonginan warrants that our products, when utilized in accordance with our handling and installation instructions, will meet or exceed our specifications for the lifetime of the structure.

RECOMMENDATIONS:

- A **hearing stiffener** is required in all engineered applications with **labeled** reactions greater than shown in the I-joist properties table found in the **I-joist Construction Guide** [C101]. The gap between the stiffener and its flange is at the top.
- A **hearing stiffener** is required when the I-joist is supported in a hanger and the sides of the hanger do not extend up to, and support, the top flange. The gap between the stiffener and flange is at the top.
- A **load stiffener** is required at locations where a **labeled** concentrated load greater than 2,370 lbs is applied to the top flange between supports, or in the case of a cantilever, anywhere between the cantilever fix and the support. These values are for standard term load duration, and may be adjusted for other load durations as permitted by the code. The gap between the stiffener and the flange is at the bottom.

The diagram illustrates three methods of attaching a web stiffener to a beam:

- Flange width:** Shows a stiffener attached to the flange with (4) 2-1/2" nails. The gap between the stiffener and the flange is 1/8"-1/4". The stiffener is approximately 2" wide. The flange width is 3-1/2".
- CONCENTRATED LOAD (Load stiffener):** Shows a stiffener attached to the web with a tight joint and no gap. The stiffener is approximately 2" wide.
- END BEARING (Bearing stiffener):** Shows a stiffener attached to the web with a gap and a tight joint. The stiffener is approximately 2" wide.

See the adjacent table for web stiffener size requirements.

Method 1 — SHEATHING REINFORCEMENT ONE SIDE


-

NOTE: Canadian softwood plywood sheathing or equivalent (minimum thickness 3/4") required on sides of joist. Depth shall match the full height of the joist. Nail with 2-1/2" nails at 6" o.c., top and bottom flange. Install with face grain horizontal. Attach joist to plate at all supports per detail 1b. Verify reinforced joist capacity.

8a ATTACHMENT DETAILS WHERE RIM BOARDS ABUT

-

8b TOE-NAIL
CONNECTION
AT RIM BOARD



NORDIC STRUCTURES

COMPANY
Apr. 9, 2020 10:01


PROJECT
J1 1ST FLOOR.wvb

Design Check Calculation Sheet Nordic Sizer – Canada 7.2

Loads:

Load	Type	Distribution	Pat-tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

Maximum Reactions (lbs) and Support Bearing (in):

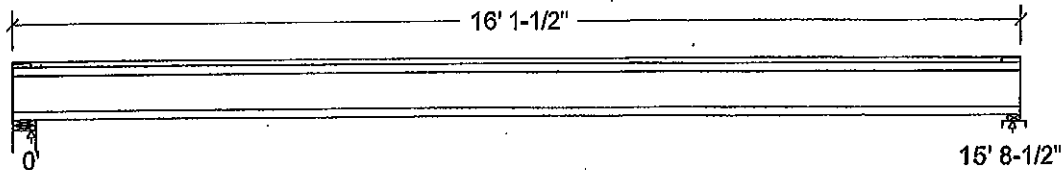

Unfactored:			
Dead	157		157
Live	314		314
Factored:			
Total	668		668
Bearing:			
Capacity			
Joist	1893		1865
Support	7744		3971
Des ratio			
Joist	0.35		0.36
Support	0.09		0.17
Load case	#2		#2
Length	4-3/8		2-3/8
Min req'd	1-3/4		1-3/4
Stiffener	No		No
KD	1.00		1.00
KB support	-		1.00
fcp sup	769		769
Kzcp sup	-		1.09


Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

Nordic 9-1/2" NI-40x Floor joist @ 12" o.c.

Supports: 1 - Lumber Wall, No.1/No.2; 2 - Lumber Sill plate, No.1/No.2;
Total length: 16' 1-1/2"; Clear span: 15' 6-3/4"; 3/4" nailed and glued OSB sheathing
This section **PASSES** the design code check.

Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 668	Vr = 1895	lbs	Vf/Vr = 0.35
Moment (+)	Mf = 2622	Mr = 4824	lbs-ft	Mf/Mr = 0.54
Perm. Defl'n	0.12 = < L/999	0.52 = L/360	in	0.22
Live Defl'n	0.23 = L/817	0.39 = L/480	in	0.59
Total Defl'n	0.35 = L/545	0.79 = L/240	in	0.44
Bare Defl'n	0.28 = L/684	0.52 = L/360	in	0.53
Vibration	Imax = 15'-8.5	Lv = 17'-1.8	f	0.92
Defl'n	= 0.031	= 0.041	in	0.76



DWG NO. JAM 6078 -20
STRUCTURAL
COMPONENT ONLY

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
EI	218.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L

Moment(+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake

L=live(use,occupancy) Ls=live(storage,equipment) f=fire

Load Patterns: s=S/2 L=L+Ls _=no pattern load in this span

All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:E_{Ieff} = 265.29 lb-in² K= 4.94e06 lbs


"Live" deflection is due to all non-dead loads (live, wind, snow...)

CONFORMS TO OBC 2012

AMENDED 2020

Design Notes:

1. WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4, and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to Nordic Structures technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.

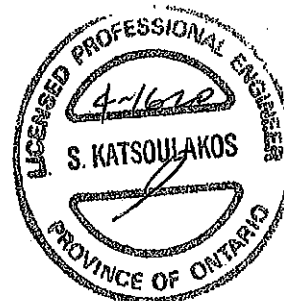

AWD NO. YAW6076-20
STRUCTURAL
COMPONENT ONLY

NORDIC STRUCTURES

COMPANY
Apr. 9, 2020 09:59


PROJECT
J1 2ND FLOOR.wwb

Design Check Calculation Sheet Nordic Sizer – Canada 7.2

Loads:

Load	Type	Distribution	Pat-tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

Maximum Reactions (lbs) and Support Bearing (in):

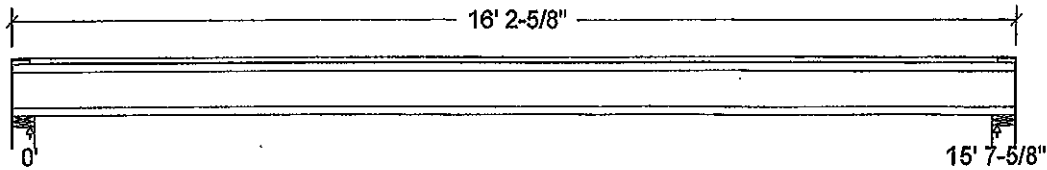

Unfactored:			
Dead	156		156
Live	313		313
Factored:			
Total	.664		664
Bearing:			
Capacity			
Joist	1893		1893
Support	7744		7744
Des ratio			
Joist	0.35		0.35
Support	0.09		0.09
Load case	#2		#2
Length	4-3/8		4-3/8
Min req'd	1-3/4		1-3/4
Stiffener	No		No
KD	1.00		1.00
KB support	-		-
fcp sup	769		769
Kzcp sup	-		-

Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

Nordic 9-1/2" NI-40x Floor joist @ 12" o.c.


Supports: All - Lumber Wall, No.1/No.2

Total length: 16' 2-5/8"; Clear span: 15' 5-7/8"; 5/8" nailed and glued OSB sheathing with 1/2" gypsum ceiling

This section PASSES the design code check.

Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 664	Vr = 1895	lbs	Vf/Vr = 0.35
Moment (+)	Mf = 2597	Mr = 4824	lbs-ft	Mf/Mr = 0.54
Perm. Defl'n	0.12 = < L/999	0.52 = L/360	in	0.22
Live Defl'n	0.23 = L/808	0.39 = L/480	in	0.59
Total Defl'n	0.35 = L/539	0.78 = L/240	in	0.45
Bare Defl'n	0.27 = L/694	0.52 = L/360	in	0.52
Vibration	Lmax = 15'-7.6	Lv = 16'-8.5	ft	0.94
Defl'n	= 0.034	= 0.041	in	0.81



DWG NO. TAM 6079 -20
STRUCTURAL
ANALYSIS ONLY

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
EI	218.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L

Moment(+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth, groundwater E=earthquake
L=live (use, occupancy) Ls=live (storage, equipment) f=fire

Load Patterns: s=S/2 L=L+Ls _=no pattern load in this span

All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:E_{IEff} = 258.29 lb-in² K= 4.94e06 lbs


"Live" deflection is due to all non-dead loads (live, wind, snow...)

CONFORMS TO OBC 2012

AMENDED 2020

Design Notes:

1. WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4, and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to Nordic Structures technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.

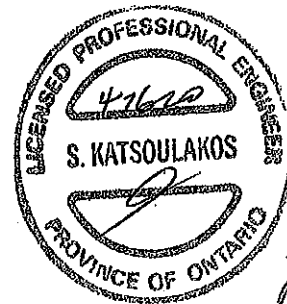

SWB NO. YAW 6079-20
STRUCTURAL
COMPONENT ONLY

NORDIC STRUCTURES

COMPANY
Apr. 9, 2020 10:02


PROJECT
J6 2ND FLOOR.wwb

Design Check Calculation Sheet Nordic Sizer -- Canada 7.2

Loads:

Load	Type	Distribution	Pat-tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

Maximum Reactions (lbs) and Support Bearing (in):

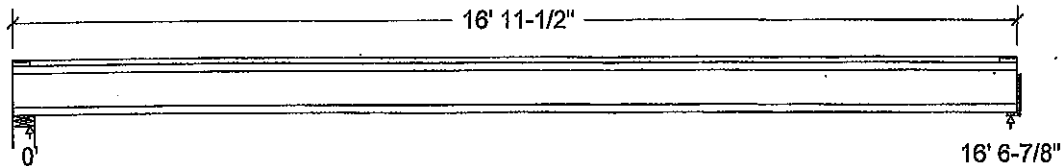

Unfactored:			
Dead	166		166
Live	331		331
Factored:			
Total	704		704
Bearing:			
Capacity			
Joist	1893		1893
Support	10841		-
Des ratio			
Joist	0.37		0.37
Support	0.06		-
Load case	#2		#2
Length	4-3/8		2
Min req'd	1-3/4		1-3/4
Stiffener	No		No
KD	1.00		1.00
KB support	-		-
fcp sup	769		-
Kzcp sup	-		-

Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

Nordic 9-1/2" NI-80 Floor Joist @ 12" o.c.


Supports: 1 - Lumber Wall, No.1/No.2; 2 - Hanger;

Total length: 16' 11-1/2"; Clear span: 16' 5-1/8"; 5/8" nailed and glued OSB sheathing with 1/2" gypsum ceiling

This section **PASSES** the design code check.

Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 704	Vr = 1895	lbs	Vf/Vr = 0.37
Moment (+)	Mf = 2918	Mr = 8958	lbs-ft	Mf/Mr = 0.33
Perm. Defl'n	0.11 = < L/999	0.55 = L/360	in	0.19
Live Defl'n	0.21 = L/940	0.41 = L/480	in	0.51
Total Defl'n	0.32 = L/626	0.83 = L/240	in	0.38
Bare Defl'n	0.24 = L/841	0.55 = L/360	in	0.43
Vibration	Lmax = 16'-6.9	Lv = 17'-9.5	ft	0.93
Defl'n	= 0.031	= 0.038	in	0.80

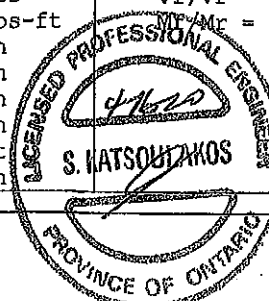

OWN NO. 7486 6060-20
STRUCTURAL
COMPONENT ONLY

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	8958	1.00	1.00	-	1.000	-	-	-	#2
EI	324.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L

Moment(+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake
L=live(use,occupancy) Ls=live(storage,equipment) f=fire

Load Patterns: s=S/2 L=L+Ls _no pattern load in this span

All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:E_Ieff = 367.27 lb-in² K= 4.94e06 lbs


"Live" deflection is due to all non-dead loads (live, wind, snow...)

CONFORMS TO OBC 2012

AMENDED 2020

Design Notes:

1. WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4, and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to Nordic Structures technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.

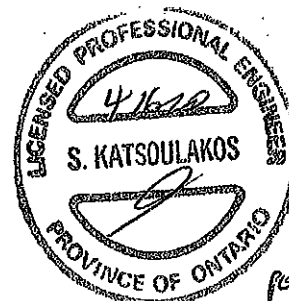

DWG NO. YAW 6080-20
STRUCTURAL
COMPONENT ONLY

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Dropped Beams\B13 DR(I1726) (Dropped Beam)**

Dry | 1 span | No cant.

February 10, 2020 11:38:52

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CGMC 12472-R


File name: MOUNTAINASH 6 EL 1.mmdl

Description: 2ND FLR FRAMING\Dropped Beams\B13 DR(I1726)

Specifier:

Designer:

Company:

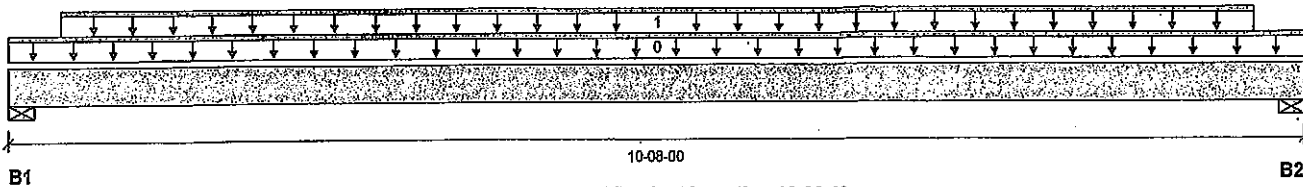**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 4"	1619 / 0	861 / 0		
B2, 4"	1618 / 0	861 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	10-08-00	Top	1.00	0.85	1.00	1.15	00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-05-04	10-02-12	Top	313	156			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	8926 ft-lbs	23220 ft-lbs	38.4%	1	05-08-12
End Shear	3236 lbs	11571 lbs	28.0%	1	01-01-08
Total Load Deflection	L/523 (0.232")	n/a	45.9%	4	04-11-04
Live Load Deflection	L/800 (0.152")	n/a	45.0%	5	04-11-04
Max Defl.	0.232"	n/a	n/a	4	04-11-04
Span / Depth	12.8				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 4" x 3-1/2"	3504 lbs	18.8%	20.5%	Spruce-Pine-Fir
B2	Wall/Plate 4" x 3-1/2"	3503 lbs	18.8%	20.5%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume unbraced length of Top: 00-02-08, Bottom: 00-02-08.

Resistance Factor phi has been applied to all presented results per CSA O86. **AMENDED 2020**

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.


Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®



PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 12" O/C FOR MULTI-PLY NAILING, MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS



DWG NO. FAM6001-20
STRUCTURAL
COMPONENT ONLY


BC CALC® Member Report
Build 7239
Job name:
Address:
City, Province, Postal Code:
Customer:
Code reports:

Dry | 1 span | No cant.

February 10, 2020 11:38:52

File name: MOUNTAINASH 6 EL 1.mmdl
Description: 2ND FLR FRAMING\Flush Beams\B10(i2111) (Flush Beam)
Specifier:
Designer:
Company:

CCMC 12472-R

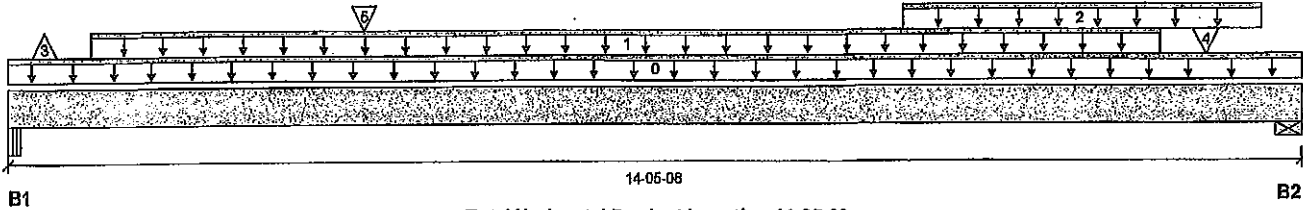

Total Horizontal Product Length = 14-05-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 4-1/2"	2574 / 597	1313 / 0		
B2, 5-1/2"	2883 / 0	1649 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.85	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	14-05-08	Top		19			00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-11-00	12-11-00	Top	353	176			n/a
2	STAIR	Unf. Lin. (lb/ft)	L	10-00-00	14-00-00	Top	120	60			n/a
3	J6(i1586)	Conc. Pt. (lbs)	L	00-05-00	00-05-00	Top	-597	-282			n/a
4	J6(i2121)	Conc. Pt. (lbs)	L	13-05-00	13-05-00	Top	338	169			n/a
5	B11(i2153)	Conc. Pt. (lbs)	L	03-11-10	03-11-10	Top	305	406			n/a

Controls Summary



	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	21228 ft-lbs	48297 ft-lbs	44.0%	1	07-05-00
End Shear	5935 lbs	23142 lbs	25.6%	1	13-02-08
Total Load Deflection	L/317 (0.52")	n/a	75.6%	6	07-02-00
Live Load Deflection	L/508 (0.325")	n/a	70.9%	8	07-02-00
Max Defl.	0.52"	n/a	n/a	6	07-02-00
Span / Depth	17.4				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 4-1/2" x 7"	5502 lbs	28.4%	14.3%	Spruce-Pine-Fir
B2	Wall/Plate 5-1/2" x 7"	6387 lbs	27.0%	13.6%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
Design meets Code minimum (L/360) Live load deflection criteria.
Calculations assume member is fully braced.
Resistance Factor phi has been applied to all presented results per CSA O86. **AMENDED 2020**
BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.
Design based on Dry Service Condition.
Importance Factor: Normal Part code: Part 9

CONFORMS TO CBC 2012

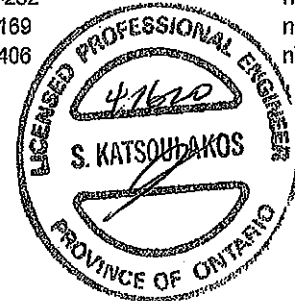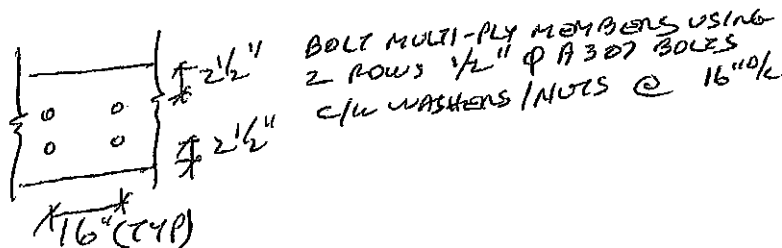

41610 TAM 6082-20

STRUCTURAL COMPONENT ONLY Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA).
Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods.
Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJST™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

BC CALC® Member Report

Bulld 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 6 EL 1.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B11(I2153)

Specifier:

Designer:

Company:

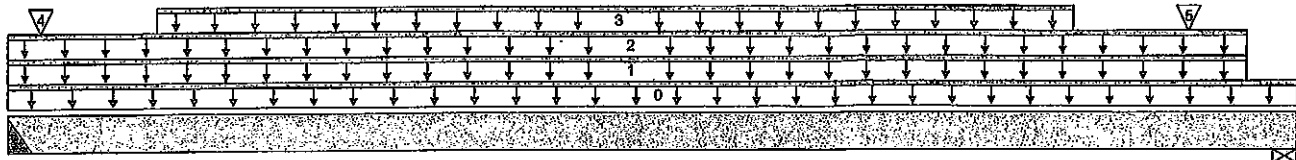

07-08-02

B1

B2

Total Horizontal Product Length = 07-08-02

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2"	307 / 0	409 / 0		
B2, 3-3/4"	290 / 0	393 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.85	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	07-06-02	Top		10			00-00-00
1	WALL	Unf. Lin. (lb/ft)	L	00-00-00	07-02-06	Top		60			n/a
2	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	07-02-06	Top	6	3			n/a
3	Smoothed Load	Unf. Lin. (lb/ft)	L	00-10-06	06-02-06	Top	76	38			n/a
4	J5(1619)	Conc. Pt. (lbs)	L	00-02-06	00-02-06	Top	70	35			n/a
5	J5(1506)	Conc. Pt. (lbs)	L	06-10-06	06-10-06	Top	77	39			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1645 ft-lbs	23220 ft-lbs	7.1%	1	03-11-06
End Shear	744 lbs	11571 lbs	6.4%	1	06-04-14
Total Load Deflection	L/999 (0.022")	n/a	n/a	4	03-08-06
Live Load Deflection	L/999 (0.009")	n/a	n/a	5	03-08-06
Max Defl.	0.022"	n/a	n/a	4	03-08-06
Span / Depth	9.0				

			Demand/Resistance Support	Demand/Resistance Member	Material	
Bearing Supports	Dim. (LxW)	Demand				
B1	Hanger	2" x 3-1/2"	972 lbs	n/a	11.4%	Hanger
B2	Wall/Plate	3-3/4" x 3-1/2"	926 lbs	11.5%	5.8%	Spruce-Pine-Fir

Cautions

Hanger model Hanger was not found. Hanger has not been analyzed for adequate capacity.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86. AMENDED 2020



BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

PROVIDE 3 ROWS OF 3/2" ARDOX SPIRAL NAILS @ 12" O/C FOR MULTI-PLY NAILING, MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS

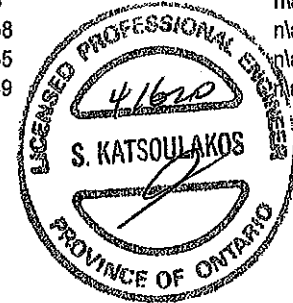

OWN NO. YAM 6083-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,


BC CALC® Member Report
 Build 7239
 Job name:
 Address:
 City, Province, Postal Code:
 Customer:
 Code reports:

Dry | 1 span | No cant.

February 10, 2020 11:38:52

File name: MOUNTAINASH 6 EL 1.mmdl
 Description: 2ND FLR FRAMING\Flush Beams\B12(I1651)
 Specifier:
 Designer:
 Company:

CCMC 12472-R

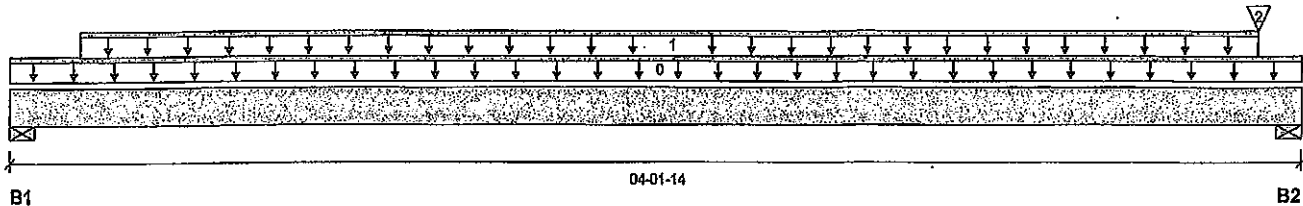

Total Horizontal Product Length = 04-01-14

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/2"	52 / 0	36 / 0		
B2, 3-1/2"	51 / 0	35 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	04-01-14	Top		5			00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-02-12	04-00-02	Top	27	13			n/a
2	FC2 Floor Material	Conc. Pt. (lbs)	L	04-00-02	04-00-02	Top	2	1			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	98 ft-lbs	11610 ft-lbs	0.8%	1	02-01-15
End Shear	57 lbs	5785 lbs	1.0%	1	01-03-00
Total Load Deflection	L/999 (0.001")	n/a	n/a	4	02-01-15
Live Load Deflection	L/999 (0")	n/a	n/a	5	02-01-15
Max Defl.	0.001"	n/a	n/a	4	02-01-15
Span / Depth	4.5				

Bearing Supports


	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 5-1/2" x 1-3/4"	123 lbs	2.1%	1.0%	Spruce-Pine-Fir
B2	Wall/Plate 3-1/2" x 1-3/4"	121 lbs	3.2%	1.6%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Calculations assume member is fully braced.
 Resistance Factor phi has been applied to all presented results per CSA O86.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020

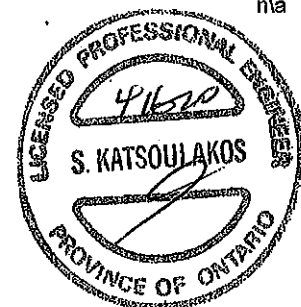

DWG NO. TAM 6084-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of Input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

BC CALC® Member Report

Build 7239

Job name:

File name: MOUNTAINASH 6 EL 1.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B14(12151)

City, Province, Postal Code:

Specifier:


Customer:

Designer:

Code reports:

CCMC 12472-R

Company:

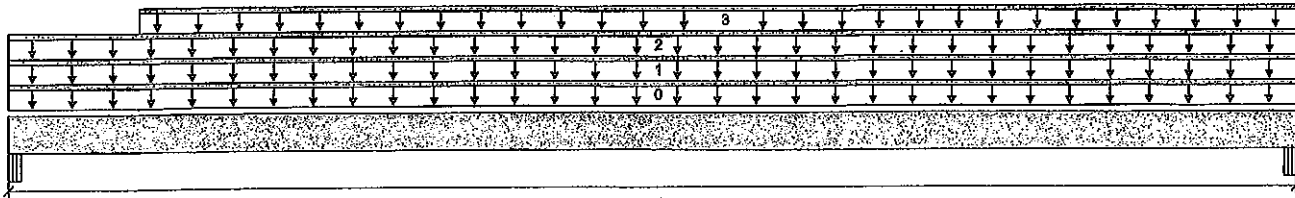

B1

Total Horizontal Product Length = 02-01-08

B2

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2-5/8"	43 / 0	120 / 0	42 / 0	
B2, 4-1/8"	55 / 0	138 / 0	47 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	02-01-08	Top	10	20	42		00-00-00
1	SNOW	Unf. Lin. (lb/ft)	L	00-00-00	02-01-08	Top	22	80			n/a
2	WALL	Unf. Lin. (lb/ft)	L	00-00-00	02-01-08	Top	27	13			n/a
3	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-02-10	02-01-08	Top					n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	96 ft-lbs	23220 ft-lbs	0.4%	1	01-00-02
End Shear	2 lbs	7521 lbs	n/a	0	01-00-02
Total Load Deflection	L/999 (0")	n/a	n/a	35	01-00-02
Max Defl.	0"	n/a	n/a	35	01-00-02
Span / Depth	2.1				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Beam	2-5/8" x 3-1/2"	188 lbs	5.3%	2.3%	Unspecified
B2 Beam	4-1/8" x 3-1/2"	302 lbs	3.9%	1.7%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.


Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AWENDED 2020



PROVIDE 3 ROWS OF 3/2" ARDOX SPIRAL NAILS @ 8" O/C FOR MULTI-PLY NAILING, MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS



DWG NO. YAM 6095-20

STRUCTURAL COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJST™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,


BC CALC® Member Report
Build 7239
Job name:
Address:
City, Province, Postal Code:
Customer:
Code reports:

Dry | 1 span | No cant.

February 10, 2020 11:38:52

File name: MOUNTAINASH 6 EL 1.mmdl
Description: 2ND FLR FRAMING\Flush Beams\B16(I2154)
Specifier:
Designer:
Company:

CCMC 12472-R

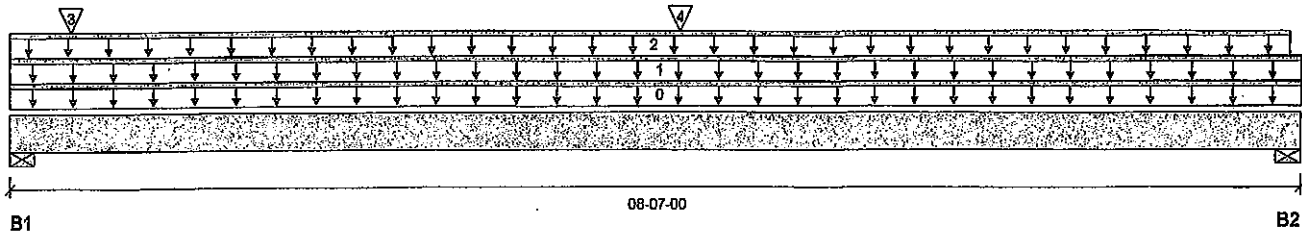

Total Horizontal Product Length = 08-07-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/2"	184 / 0	517 / 0	187 / 0	
B2, 5-1/2"	120 / 0	452 / 0	65 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	08-07-00	Top		10			00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	08-07-00	Top	20	10			n/a
2	WALL	Unf. Lin. (lb/ft)	L	00-00-00	08-06-01	Top		80			n/a
3	WINDOW	Conc. Pt. (lbs)	L	00-05-00	00-05-00	Top	66	60	126		n/a
4	WINDOW	Conc. Pt. (lbs)	L	04-05-00	04-05-00	Top	66	60	126		n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1221 ft-lbs	15093 ft-lbs	8.1%	0	04-05-00
End Shear	468 lbs	7621 lbs	6.2%	0	07-04-00
Total Load Deflection	L/999 (0.028")	n/a	n/a	35	04-03-13
Live Load Deflection	L/999 (0.01")	n/a	n/a	51	04-03-13
Max Defl.	0.028"	n/a	n/a	35	04-03-13
Span / Depth	9.8				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 5-1/2" x 3-1/2"	723 lbs	9.4%	4.7%	Spruce-Pine-Fir
B2	Wall/Plate 5-1/2" x 3-1/2"	633 lbs	8.2%	4.1%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.


Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

AMENDED 2020



PROVIDE 2 ROWS OF 3/2" ARDOX SPIRAL NAILS @ 12" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS



Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,
DWG NO. TAM 6086-20
STRUCTURAL

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 6 EL 1.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B8(12152)

Specifier:

Designer:

Company:

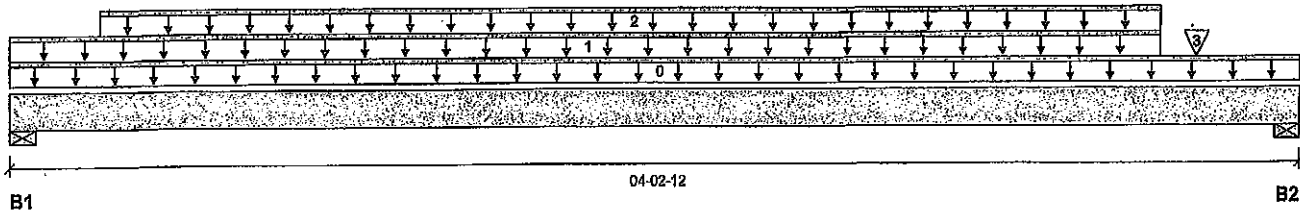

Total Horizontal Product Length = 04-02-12

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	41 / 0	144 / 0		
B2, 5-1/2"	36 / 0	143 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	04-02-12	Top	1.00	0.65	1.00	1.15	00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	03-09-04	Top	20	10			n/a
2	WALL	Unf. Lin. (lb/ft)	L	00-03-08	03-09-04	Top		60			n/a
3	FC2 Floor Material	Conc. Pt. (lbs)	L	03-10-10	03-10-10	Top	1				n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	181 ft-lbs	15093 ft-lbs	1.2%	0	02-00-06
End Shear	106 lbs	7521 lbs	1.4%	0	01-01-00
Total Load Deflection	L/999 (0.001")	n/a	n/a	4	02-00-06
Live Load Deflection	L/999 (0")	n/a	n/a	5	02-00-06
Max Defl.	0.001"	n/a	n/a	4	02-00-06
Span / Depth	4.6				



ENG NO. 41620-20
STRUCTURAL
COMPONENT ONLY

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 3-1/2" x 3-1/2"	202 lbs	4.1%	2.1%	Spruce-Pine-Fir
B2	Wall/Plate 5-1/2" x 3-1/2"	201 lbs	2.6%	1.3%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020

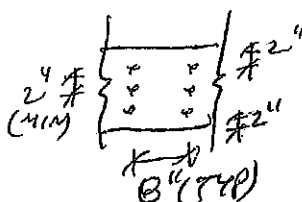

PROVIDE 3 ROWS OF 3/4" DIA
SPIRAL NAILS @ 8" O/C FOR
MULTI-PLY NAILING. MAINTAIN
A MIN. 2" LUMBER EDGE/END
DISTANCE. DO NOT USE AIR NAILS

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 6 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B1(1955)

Specifier:

Designer:

Company:

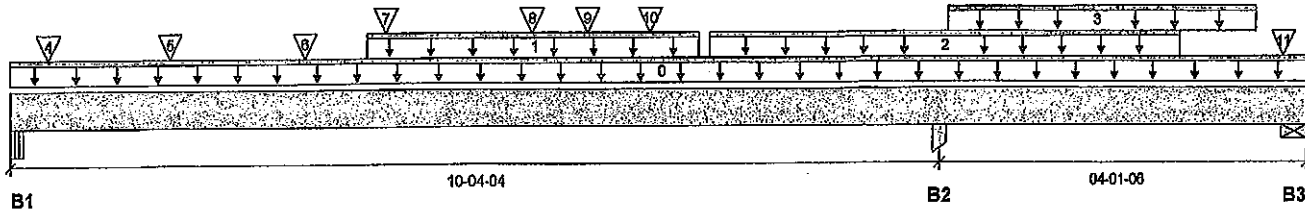

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/4"	3149 / 27	1723 / 0		
B2, 4-1/2"	5407 / 0	2876 / 0		
B3, 5-1/2"	4368 / 1288	3245 / 0		


Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	14-05-10	Top	100	10			00-00-00
1	STAIR	Unf. Lin. (lb/ft)	L	03-11-10	07-07-10	Top	240	120			n/a
2	Smoothed Load	Unf. Lin. (lb/ft)	L	07-09-02	13-01-02	Top	323	161			n/a
3	STAIR	Unf. Lin. (lb/ft)	L	10-05-06	13-10-10	Top	240	120			n/a
4	J2(I2040)	Conc. Pt. (lbs)	L	00-05-02	00-05-02	Top	1454	789			n/a
5	J2(I2099)	Conc. Pt. (lbs)	L	01-09-02	01-09-02	Top	431	215			n/a
6	-	Conc. Pt. (lbs)	L	03-03-04	03-03-04	Top	522	261			n/a
7	-	Conc. Pt. (lbs)	L	04-02-02	04-02-02	Top	710	417			n/a
8	J2(I2016)	Conc. Pt. (lbs)	L	05-09-02	05-09-02	Top	295	147			n/a
9	J2DJ(I2081)	Conc. Pt. (lbs)	L	06-04-10	06-04-10	Top	265	127			n/a
10	J2(I1959)	Conc. Pt. (lbs)	L	07-01-02	07-01-02	Top	332	166			n/a
11	-	Conc. Pt. (lbs)	L	14-02-06	14-02-06	Top	3733	3598			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	9867 ft-lbs	23220 ft-lbs	42.5%	2	04-05-02
Neg. Moment	-10975 ft-lbs	-23220 ft-lbs	47.3%	1	10-04-04
End Shear	3496 lbs	11571 lbs	30.2%	2	01-02-12
Cont. Shear	5922 lbs	11571 lbs	51.2%	1	09-04-08
Total Load Deflection	L/584 (0.205")	n/a	41.1%	9	04-11-02
Live Load Deflection	L/886 (0.135")	n/a	40.7%	12	04-11-02
Total Neg. Defl.	L/999 (-0.021")	n/a	n/a	9	11-10-09
Max Defl.	0.205"	n/a	n/a	9	04-11-02
Span / Depth	12.6				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Beam	5-1/4" x 3-1/2"	6878 lbs	70.1%	30.7%	Unspecified
B2 Column	4-1/2" x 3-1/2"	11705 lbs	91.5%	60.9%	Unspecified
B3 Wall/Plate	5-1/2" x 3-1/2"	10607 lbs	89.6%	45.2%	Spruce-Pine-Fir

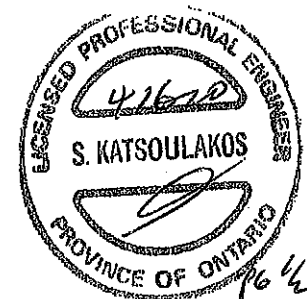

308 NO. 7AM 6086-20
STRUCTURAL
COMPONENT ONLY



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

1ST FLR FRAMING\Flush Beams\B1(1955) (Flush Beam)

Dry | 2 spans | No cant.

February 10, 2020 11:38:52

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R

File name: MOUNTAINASH 6 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B1(1955)

Specifier:

Designer:

Company:

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020



PROVIDED 3 ROWS OF 3/4\"/>



DWG NO. YAM 6088-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 6 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B2(I1994)

Specifier:

Designer:

Company:

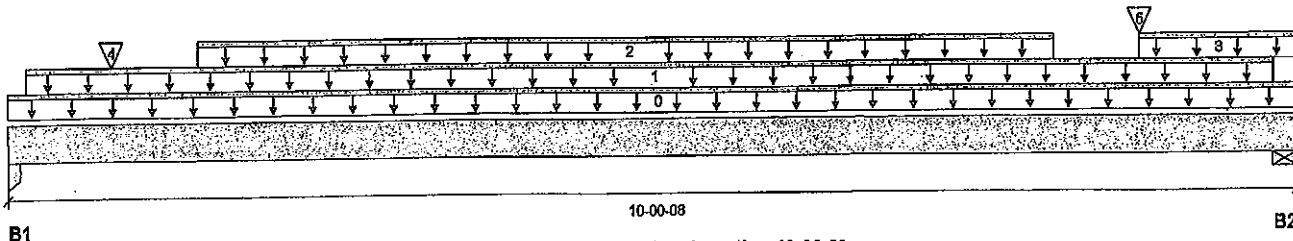

Total Horizontal Product Length = 10-00-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 1-3/4"	985 / 0	834 / 0		
B2, 1-7/8"	942 / 0	810 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	10-00-08	Top		10			00-00-00
1	WALL	Unf. Lin. (lb/ft)	L	00-01-12	09-10-02	Top		60			n/a
2	Smoothed Load	Unf. Lin. (lb/ft)	L	01-05-10	08-01-10	Top	210	104			n/a
3	FC1 Floor Material	Unf. Lin. (lb/ft)	L	08-09-10	10-00-08	Top	22				n/a
4	J4(I1985)	Conc. Pt. (lbs)	L	00-09-10	00-09-10	Top	244	122			n/a
5	J4(I1973)	Conc. Pt. (lbs)	L	08-09-10	08-09-10	Top	262	131			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	6498 ft-lbs	23220 ft-lbs	28.0%	1	04-09-10
End Shear	2370 lbs	11571 lbs	20.5%	1	09-01-02
Total Load Deflection	L/728 (0.163")	n/a	33.0%	4	05-00-10
Live Load Deflection	L/999 (0.089")	n/a	n/a	5	05-00-10
Max Defl.	0.163"	n/a	n/a	4	05-00-10
Span / Depth	12.5				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Column 1-3/4" x 3-1/2"	2520 lbs	50.7%	33.7%	Unspecified
B2	Wall/Plate 1-7/8" x 3-1/2"	2426 lbs	60.1%	30.3%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86. AMENDED 2020



BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 12" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS

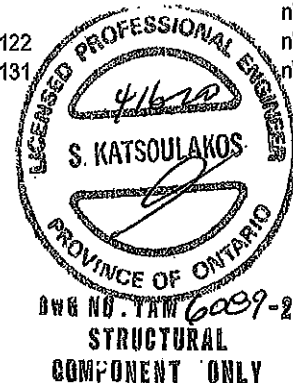

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJST™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R

File name: MOUNTAINASH 6 EL 1.mmdl


Description: 1ST FLR FRAMING\Flush Beams\B3(11931)

Specifier:

Designer:

Company:

February 10, 2020 11:38:52

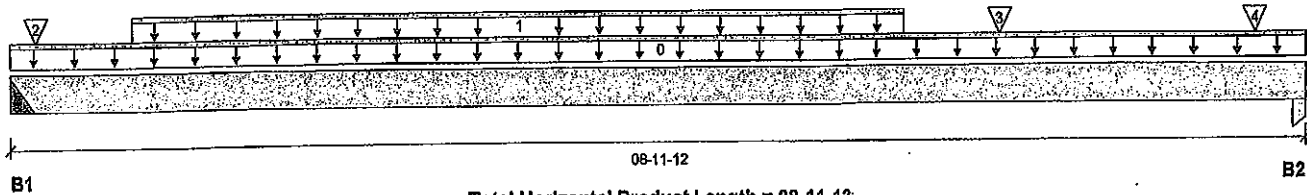

Total Horizontal Product Length = 08-11-12

Reaction Summary (Down / Uplift) (lbs)


Bearing	Live	Dead	Snow	Wind
B1, 2"	358 / 0	222 / 0		
B2, 3-1/2"	810 / 0	999 / 0		

Load Summary

Load Summary							Live	Dead	Snow	Wind	Tributary
Tag	Description	Load Type	Ref.	Start	End	Loc.	1.00	0.65	1.00	1.15	
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	08-11-12	Top		10			00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-10-04	06-02-04	Top	80	40			n/a
2	J7(i2069)	Conc. Pt. (lbs)	L	00-02-04	00-02-04	Top	67	34			n/a
3	J7(i2079)	Conc. Pt. (lbs)	L	06-10-04	06-10-04	Top	108	54			n/a
4	-	Conc. Pt. (lbs)	L	08-07-07	08-07-07	Top	559	830			n/a

Controls Summary

Controls Summary	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1714 ft-lbs	23220 ft-lbs	7.4%	1	04-02-04
End Shear	706 lbs	11571 lbs	6.1%	1	07-10-12
Total Load Deflection	L/999 (0.032")	n/a	n/a	4	04-04-04
Live Load Deflection	L/999 (0.02")	n/a	n/a	5	04-04-04
Max Defl.	0.032"	n/a	n/a	4	04-04-04
Span / Depth	10.9				



DWG NO. YAHN 6090-20

**STRUCTURAL
COMPONENT ONLY**

Bearing Supports

Bearing Supports			Dim. (LxW)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material
B1	Hanger	2" x 3-1/2"		813 lbs	n/a	9.5%	Hanger
B2	Column	3-1/2" x 3-1/2"		2463 lbs	24.8%	16.5%	Unspecified

Cautions

Cautions
Hanger model Hanger was not found. Hanger has not been analyzed for adequate capacity.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume unbraced length of Top: 00-00-00, Bottom: 00-00-00. CONFORMS TO OBC 2012

Hanger Manufacturer: Unassigned

Resistance Factor ϕ has been applied to all presented results per CSA O86. **AMENDED 2020**

BC GAI G® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

PROVIDE 3 ROWS OF 3/4" ARDOX
SPIRAL NAILS @ 8" O/C FOR
MULTI-PLY NAILING. MAINTAIN
A MIN. 2" LUMBER EDGE/END
DISTANCE. DO NOT USE AIR NAILS

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™,
ALLJOIST®, BC RIM BOARD™, BCi®,
BOISE GLULAM™, BC FloorValue®,
VERSA-LAM®, VERSA-RIM PLUS®

2" 夹 (min)  2" 夹

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 6 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B4(i2084)

Specifier:

Designer:

Company:

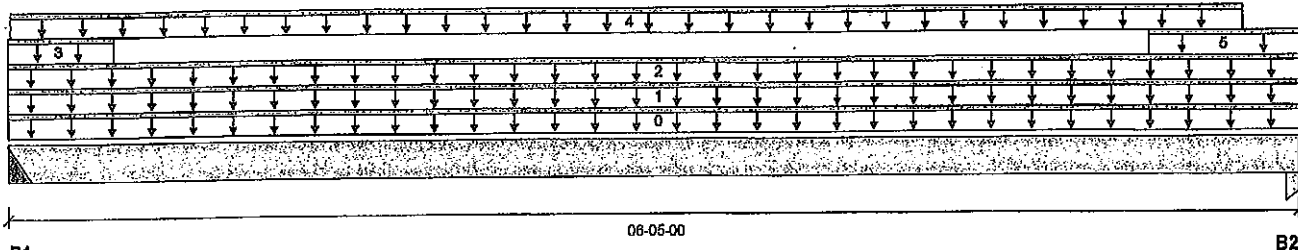

Total Horizontal Product Length = 06-05-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2"	344 / 0	618 / 0		
B2, 3-1/2"	167 / 0	496 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	06-05-00	Top		5			00-00-00
1	3(i760)	Unf. Lin. (lb/ft)	L	00-00-00	06-05-00	Top		81			n/a
2	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	06-05-00	Top	19	9			n/a
3	3(i760)	Unf. Lin. (lb/ft)	L	00-00-00	00-06-06	Top	427	536			n/a
4	3(i760)	Unf. Lin. (lb/ft)	L	00-00-02	06-01-08	Top	20	12			n/a
5	3(i760)	Unf. Lin. (lb/ft)	L	05-08-00	06-05-00	Top	53	192			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	748 ft-lbs	7546 ft-lbs	9.9%	0	03-01-12
End Shear	594 lbs	3761 lbs	15.8%	0	00-11-08
Total Load Deflection	L/999 (0.02")	n/a	n/a	4	03-01-12
Live Load Deflection	L/999 (0.006")	n/a	n/a	5	03-00-15
Max Defl.	0.02"	n/a	n/a	4	03-01-12
Span / Depth	7.7				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Hanger 2" x 1-3/4"	865 lbs	n/a	31.2%	Hanger
B2	Column 3-1/2" x 1-3/4"	694 lbs	21.5%	14.3%	Unspecified

Cautions

Hanger model Hanger was not found. Hanger has not been analyzed for adequate capacity.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO CBC 2012

AMENDED 2020


 STRUCTURAL
COM. UNENT ONLY
Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of Input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before Installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

1ST FLR FRAMING\Flush Beams\B5(12038) (Flush Beam)

Dry | 1 span | No cant.

February 10, 2020 11:38:52

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 6 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B5(12038)

Specifier:

Designer:

Company:

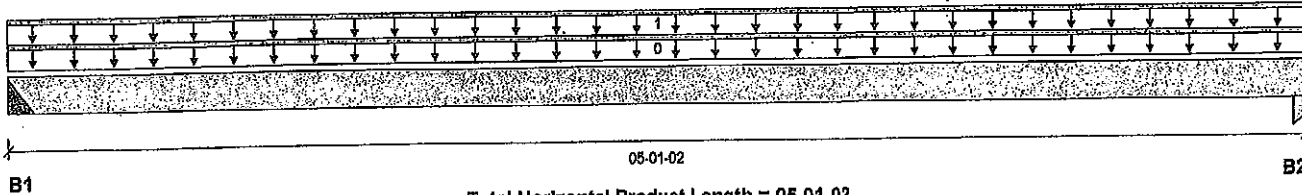

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2"	44 / 0	34 / 0		
B2, 1-3/4"	44 / 0	34 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	05-01-02	Top	1.00	0.65	1.00	1.15	00-00-00
1	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	05-01-02	Top	17	9			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	129 ft-lbs	11610 ft-lbs	1.1%	1	02-06-11
End Shear	68 lbs	5785 lbs	1.2%	1	00-11-08
Total Load Deflection	L/999 (0.002")	n/a	n/a	4	02-06-11
Live Load Deflection	L/999 (0.001")	n/a	n/a	5	02-06-11
Max Defl.	0.002"	n/a	n/a	4	02-06-11
Span / Depth	6.2				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Hanger 2" x 1-3/4"	109 lbs	n/a	2.6%	Hanger
B2	Column 1-3/4" x 1-3/4"	108 lbs	4.4%	2.9%	Unspecified

Cautions

Hanger model Hanger was not found. Hanger has not been analyzed for adequate capacity.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO ORC 2012

AMENDED 2020



SWR NO. TAM 6092-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJST™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 6 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B6(i2036)

Specifier:

Designer:

Company:

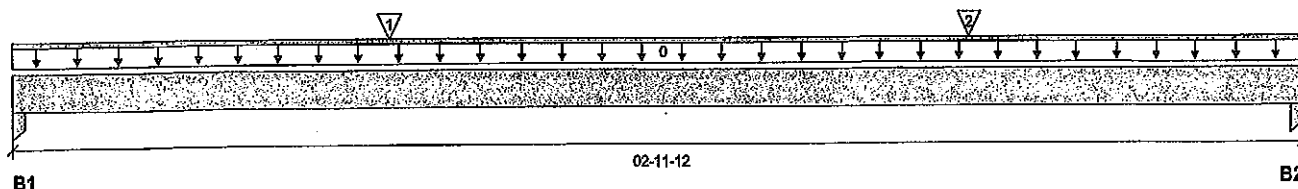
Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	113 / 0	64 / 0		
B2, 3-1/2"	119 / 0	67 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	02-11-12	Top		5			00-00-00
1	J6(i1935)	Conc. Pt. (lbs)	L	00-10-06	00-10-06	Top	118	59			n/a
2	J6(i2002)	Conc. Pt. (lbs)	L	02-02-06	02-02-06	Top	114	57			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	157 ft-lbs	11610 ft-lbs	1.3%	1	00-10-11
End Shear	174 lbs	5785 lbs	3.0%	1	01-01-00
Total Load Deflection	L/999 (0.001")	n/a	n/a	4	01-05-14
Live Load Deflection	L/999 (0")	n/a	n/a	5	01-05-14
Max Defl.	0.001"	n/a	n/a	4	01-05-14
Span / Depth	3.2				

Bearing Supports

	Dlm. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Column 3-1/2" x 1-3/4"	249 lbs	5.0%	3.3%	Unspecified
B2	Column 3-1/2" x 1-3/4"	261 lbs	5.3%	3.5%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO CBC 2012

AMENDED 2020

 DWG NO. YAW 6093-20
STRUCTURAL
 COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

**Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****1ST FLR FRAMING\Flush Beams\B7(12063) (Flush Beam)**

Dry | 1 span | No cant.

February 10, 2020 11:38:52

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code:

Customer:

Code reports:

CCMC 12472-R


File name: MOUNTAINASH 6 EL 1.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B7(12063)

Specifier:

Designer:

Company:

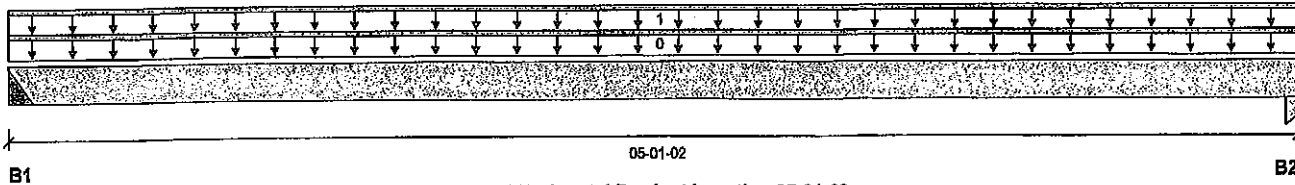**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 2"	40 / 0	32 / 0		
B2, 1-3/4"	40 / 0	32 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	05-01-02	Top	1.00	0.65	1.00	1.15	00-00-00
1	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	05-01-02	Top	16	8			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	118 ft-lbs	11610 ft-lbs	1.0%	1	02-06-11
End Shear	63 lbs	5785 lbs	1.1%	1	00-11-08
Total Load Deflection	L/999 (0.001")	n/a	n/a	4	02-06-11
Live Load Deflection	L/999 (0.001")	n/a	n/a	5	02-06-11
Max Defl.	0.001"	n/a	n/a	4	02-06-11
Span / Depth	6.2				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Hanger	2" x 1-3/4"	100 lbs	n/a	2.3%	Hanger
B2 Column	1-3/4" x 1-3/4"	99 lbs	4.0%	2.7%	Unspecified

Cautions

Hanger model Hanger was not found. Hanger has not been analyzed for adequate capacity.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

AMENDED 2020



WWW.NO.TAM 6094 -20

STRUCTURAL

COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

BC CALC® Member Report

Build 7239

Job name:

Address:

City, Province, Postal Code: WATERDOWN

Customer:

Code reports: CCMC 12472-R


File name: MOUNTAINASH 6 EL 2.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B14B(i2247)

Specifier:

Designer: AJ

Company:

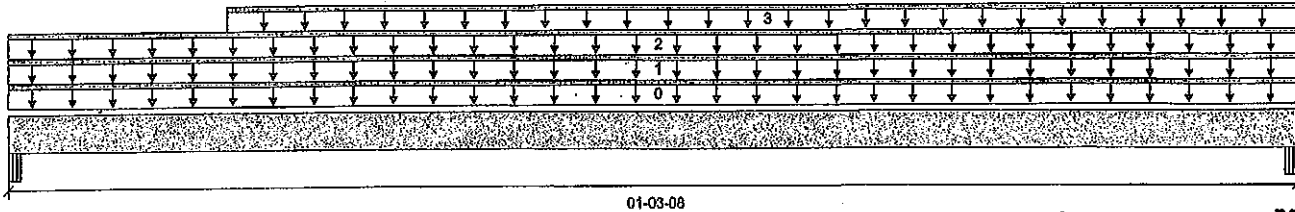

B1

01-03-08

B2

Total Horizontal Product Length = 01-03-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2-5/8"	12 / 0	69 / 0	23 / 0	
B2, 5-1/4"	17 / 0	83 / 0	32 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	01-03-08	Top	1.00	0.65	1.00	1.15	00-00-00
1	SNOW	Unf. Lin. (lb/ft)	L	00-00-00	01-03-08	Top	22	20	42		n/a
2	WALL	Unf. Lin. (lb/ft)	L	00-00-00	01-03-08	Top		80			n/a
3	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-02-10	01-03-08	Top	1				n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	11 ft-lbs	15093 ft-lbs	n/a	0	00-06-07
End Shear	49 lbs	7521 lbs	0.6%	0	00-02-10
Span / Depth	1.0				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Beam	2-5/8" x 3-1/2"	82 lbs	2.6%	1.1%	Unspecified
B2 Beam	5-1/4" x 3-1/2"	116 lbs	1.8%	0.8%	Unspecified

Notes

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.


Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

AMENDED 2020

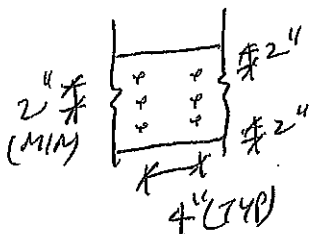

PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 4" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS



NO. TAM 6095-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

BC CALC® Member Report

Buld 7239

Job name:

Address:

City, Province, Postal Code: WATERDOWN

Customer:

Code reports: CCMC 12472-R


File name: MOUNTAINASH 6 EL 1 DECK CONDITION.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B1A(I2350)

Specifier:

Designer: AJ

Company:

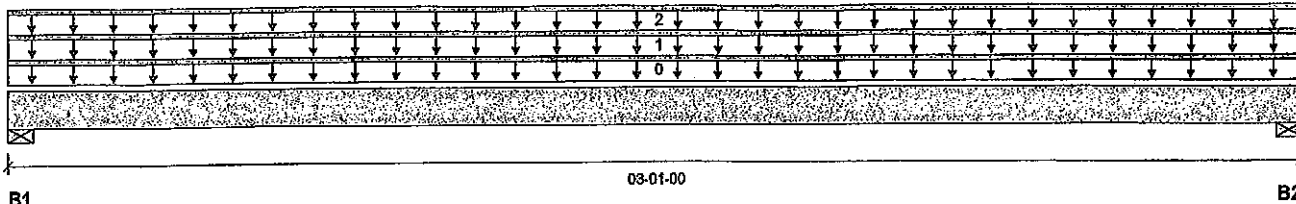

Total Horizontal Product Length = 03-01-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3"	41 / 0	160 / 0		
B2, 3"	41 / 0	160 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	03-01-00	Top	10				00-00-00
1	E3(I585)	Unf. Lin. (lb/ft)	L	00-00-00	03-01-00	Top	81				n/a
2	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	03-01-00	Top	27	13			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	133 ft-lbs	15093 ft-lbs	0.9%	0	01-06-08
End Shear	73 lbs	7521 lbs	1.0%	0	01-00-08
Total Load Deflection	L/999 (0")	n/a	n/a	4	01-06-08
Live Load Deflection	L/999 (0")	n/a	n/a	5	01-06-08
Max Defl.	0"	n/a	n/a	4	01-06-08
Span / Depth	3.4				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 3" x 3-1/2"	224 lbs	5.3%	2.7%	Spruce-Pine-Fir
B2	Wall/Plate 3" x 3-1/2"	224 lbs	5.3%	2.7%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.


Resistance Factor phi has been applied to all presented results per CSA O86. AMENDED 2020

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012




ONE NO. TAM 6096-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCIO®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

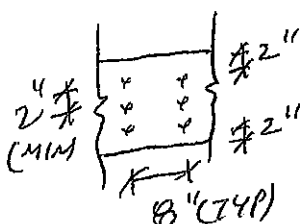

PROVIDE 3 ROWS OF 3/4" ARDOX
SPIRAL NAILS @ 8" O/C FOR
MULTI-PLY NAILING. MAINTAIN
A MIN. 2" LUMBER EDGE/END
DISTANCE. DO NOT USE AIR NAILS

BC CALC® Member Report

Build 7239

Job name:

File name: MOUNTAINASH 6 EL 1 DECK CONDITION.mmdl

Address:

Description: 1ST FLR FRAMING\Flush Beams\B1B(I2351)

City, Province, Postal Code: WATERDOWN


Specifier:

Customer:

Designer: AJ

Code reports: CCMC 12472-R

Company:

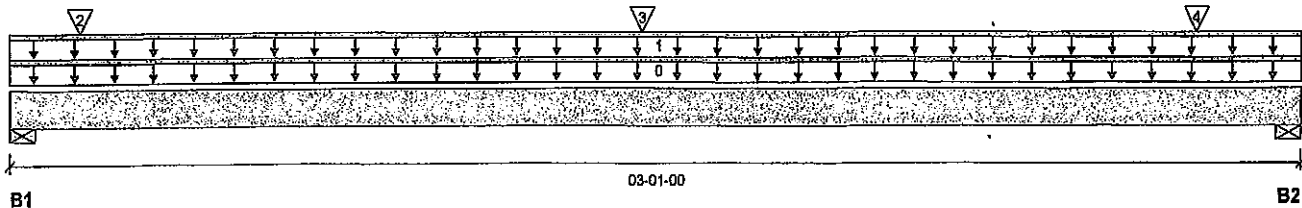

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3"	938 / 0	610 / 0		
B2, 3"	928 / 0	604 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	03-01-00	Top	10	0.65	1.00	1.15	00-00-00
1	E9(I688)	Unf. Lin. (lb/ft)	L	00-00-00	03-01-00	Top	270	216			n/a
2	J3(I2302)	Conc. Pt. (lbs)	L	00-02-00	00-02-00	Top	345	173			n/a
3	J3(I2284)	Conc. Pt. (lbs)	L	01-06-00	01-06-00	Top	345	173			n/a
4	J3(I2227)	Conc. Pt. (lbs)	L	02-10-00	02-10-00	Top	345	173			n/a

Controls Summary

Pos. Moment	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
End Shear	1125 ft-lbs	23220 ft-lbs	4.8%	1	01-06-00
Total Load Deflection	721 lbs	11571 lbs	6.2%	1	01-00-08
Live Load Deflection	L/999 (0.002")	n/a	n/a	4	01-06-07
Max Defl.	L/999 (0.001")	n/a	n/a	5	01-06-07
Span / Depth	0.002"	n/a	n/a	4	01-06-07

Bearing Supports

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 3" x 3-1/2"	2170 lbs	33.6%	16.9%	Spruce-Pine-Fir
B2	Wall/Plate 3" x 3-1/2"	2147 lbs	33.2%	16.8%	Spruce-Pine-Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.


Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86. AMENDED 2020


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

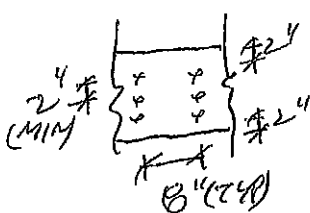

PROVIDE 3 ROWS OF 3/4" ARDOX SPIRAL NAILS @ 8" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS

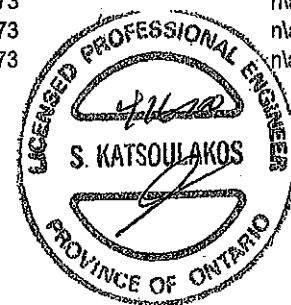

DWG NO. TAM6097-20
STRUCTURAL
COMPONENT ONLY

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA).

Completeness and accuracy of input must be reviewed and verified by a

qualified engineer or other appropriate expert to assure its adequacy, prior to

anyone relying on such output as evidence of suitability for a particular

application. The output here is based on building code-accepted design

properties and analysis methods. Installation of Boise Cascade


engineered wood products must be in accordance with current Installation

Guide and applicable building codes. To obtain Installation Guide or ask

questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®

BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,




Maximum Floor Spans

Live Load = 40 psf, Dead Load = 30 psf
Simple Spans, L/480 Deflection Limit
3/4" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-2"	13'-4"	12'-4"	15'-7"	14'-2"	13'-4"	12'-4"
	NI-40x	17'-0"	16'-0"	15'-1"	13'-11"	17'-5"	16'-1"	15'-1"	13'-11"
	NI-60	17'-2"	16'-2"	15'-5"	14'-3"	17'-6"	16'-5"	15'-5"	14'-3"
	NI-70	18'-0"	16'-11"	16'-3"	15'-6"	18'-5"	17'-3"	16'-7"	15'-6"
	NI-80	18'-3"	17'-1"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	15'-10"
11-7/8"	NI-20	17'-10"	16'-10"	16'-0"	14'-10"	18'-6"	17'-1"	16'-0"	14'-10"
	NI-40x	19'-4"	17'-11"	17'-3"	15'-10"	19'-11"	18'-6"	17'-9"	15'-10"
	NI-60	19'-7"	18'-2"	17'-5"	16'-9"	20'-2"	18'-9"	17'-11"	17'-1"
	NI-70	20'-9"	19'-2"	18'-3"	17'-5"	21'-4"	19'-9"	18'-10"	17'-10"
	NI-80	21'-1"	19'-5"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
14"	NI-90x	21'-8"	20'-0"	19'-1"	18'-0"	22'-2"	20'-6"	19'-6"	18'-6"
	NI-40x	21'-5"	19'-10"	18'-11"	17'-5"	22'-1"	20'-6"	19'-6"	17'-5"
	NI-60	21'-10"	20'-2"	19'-3"	18'-2"	22'-5"	20'-10"	19'-11"	18'-10"
	NI-70	23'-0"	21'-3"	20'-3"	19'-2"	23'-8"	21'-11"	20'-10"	19'-9"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
16"	NI-90x	24'-1"	22'-3"	21'-2"	20'-0"	24'-8"	22'-10"	21'-9"	20'-7"
	NI-60	23'-9"	22'-0"	20'-11"	19'-10"	24'-6"	22'-9"	21'-8"	20'-6"
	NI-70	25'-1"	23'-2"	22'-0"	20'-10"	25'-9"	23'-10"	22'-9"	21'-6"
	NI-80	25'-6"	23'-6"	22'-4"	21'-2"	26'-1"	24'-2"	23'-1"	21'-10"
	NI-90x	26'-4"	24'-3"	23'-1"	21'-10"	26'-11"	24'-11"	23'-8"	22'-5"

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-2"	13'-4"	12'-4"	15'-7"	14'-2"	13'-4"	12'-4"
	NI-40x	17'-0"	16'-1"	15'-1"	13'-11"	17'-9"	16'-1"	15'-1"	13'-11"
	NI-60	18'-1"	16'-5"	15'-5"	14'-3"	18'-1"	16'-5"	15'-5"	14'-3"
	NI-70	19'-10"	17'-11"	16'-9"	15'-6"	19'-10"	17'-11"	16'-9"	15'-6"
	NI-80	20'-2"	18'-3"	17'-1"	15'-10"	20'-2"	18'-3"	17'-1"	15'-10"
11-7/8"	NI-20	18'-10"	17'-1"	16'-0"	14'-10"	18'-10"	17'-1"	16'-0"	14'-10"
	NI-40x	21'-3"	19'-3"	17'-9"	15'-10"	21'-3"	19'-3"	17'-9"	15'-10"
	NI-60	21'-9"	19'-8"	18'-5"	17'-1"	21'-9"	19'-8"	18'-5"	17'-1"
	NI-70	23'-4"	21'-5"	20'-1"	18'-6"	23'-8"	21'-5"	20'-1"	18'-6"
	NI-80	23'-7"	21'-10"	20'-5"	18'-11"	24'-1"	21'-10"	20'-5"	18'-11"
14"	NI-90x	24'-3"	22'-6"	21'-3"	19'-7"	24'-8"	22'-7"	21'-3"	19'-7"
	NI-40x	24'-2"	21'-5"	19'-6"	17'-5"	24'-2"	21'-5"	19'-6"	17'-5"
	NI-60	24'-9"	22'-5"	21'-0"	19'-6"	24'-9"	22'-5"	21'-0"	19'-6"
	NI-70	26'-1"	24'-3"	22'-9"	21'-0"	26'-8"	24'-3"	22'-9"	21'-0"
	NI-80	26'-6"	24'-7"	23'-3"	21'-6"	27'-1"	24'-10"	23'-3"	21'-6"
16"	NI-90x	27'-3"	25'-4"	24'-1"	22'-4"	27'-9"	25'-10"	24'-3"	22'-4"
	NI-60	27'-3"	24'-11"	23'-5"	21'-7"	27'-6"	24'-11"	23'-5"	21'-7"
	NI-70	28'-8"	26'-8"	25'-3"	23'-4"	29'-3"	26'-11"	25'-3"	23'-4"
	NI-80	29'-1"	27'-0"	25'-9"	23'-10"	29'-8"	27'-6"	25'-10"	23'-10"
	NI-90x	29'-11"	27'-10"	26'-6"	24'-10"	30'-6"	28'-5"	26'-11"	24'-10"

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.





Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf
Simple Spans, L/480 Deflection Limit
5/8" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-2"	13'-9"	N/A	15'-7"	14'-8"	14'-2"	N/A
	NI-40x	16'-1"	15'-2"	14'-8"	N/A	16'-7"	15'-7"	15'-1"	N/A
	NI-60	16'-3"	15'-4"	14'-10"	N/A	16'-8"	15'-9"	15'-3"	N/A
	NI-70	17'-1"	16'-1"	15'-6"	N/A	17'-5"	16'-5"	15'-10"	N/A
	NI-80	17'-3"	16'-3"	15'-8"	N/A	17'-8"	16'-7"	16'-0"	N/A
11-7/8"	NI-20	16'-11"	16'-0"	15'-5"	N/A	17'-6"	16'-6"	16'-0"	N/A
	NI-40x	18'-1"	17'-0"	16'-5"	N/A	18'-9"	17'-6"	16'-11"	N/A
	NI-60	18'-4"	17'-3"	16'-7"	N/A	19'-0"	17'-8"	17'-1"	N/A
	NI-70	19'-6"	18'-0"	17'-4"	N/A	20'-1"	18'-7"	17'-9"	N/A
	NI-80	19'-9"	18'-3"	17'-6"	N/A	20'-4"	18'-10"	17'-11"	N/A
	NI-90x	20'-4"	18'-9"	17'-11"	N/A	20'-10"	19'-3"	18'-5"	N/A
14"	NI-40x	20'-1"	18'-7"	17'-10"	N/A	20'-10"	19'-4"	18'-6"	N/A
	NI-60	20'-5"	18'-11"	18'-1"	N/A	21'-2"	19'-7"	18'-9"	N/A
	NI-70	21'-7"	20'-0"	19'-1"	N/A	22'-3"	20'-7"	19'-8"	N/A
	NI-80	21'-11"	20'-3"	19'-4"	N/A	22'-7"	20'-11"	20'-0"	N/A
	NI-90x	22'-7"	20'-11"	19'-11"	N/A	23'-3"	21'-6"	20'-6"	N/A
16"	NI-60	22'-3"	20'-8"	19'-9"	N/A	23'-1"	21'-5"	20'-6"	N/A
	NI-70	23'-6"	21'-9"	20'-9"	N/A	24'-3"	22'-5"	21'-5"	N/A
	NI-80	23'-11"	22'-1"	21'-1"	N/A	24'-8"	22'-10"	21'-9"	N/A
	NI-90x	24'-8"	22'-9"	21'-9"	N/A	25'-4"	23'-5"	22'-4"	N/A

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-8"	15'-3"	14'-5"	N/A	16'-8"	15'-3"	14'-5"	N/A
	NI-40x	17'-11"	16'-11"	16'-1"	N/A	18'-5"	17'-1"	16'-1"	N/A
	NI-60	18'-2"	17'-1"	16'-4"	N/A	18'-7"	17'-4"	16'-4"	N/A
	NI-70	19'-2"	17'-10"	17'-2"	N/A	19'-7"	18'-3"	17'-7"	N/A
	NI-80	19'-5"	18'-0"	17'-4"	N/A	19'-10"	18'-5"	17'-8"	N/A
11-7/8"	NI-20	19'-6"	18'-1"	17'-3"	N/A	19'-11"	18'-3"	17'-3"	N/A
	NI-40x	21'-0"	19'-6"	18'-8"	N/A	21'-7"	20'-2"	19'-2"	N/A
	NI-60	21'-4"	19'-9"	18'-11"	N/A	21'-11"	20'-4"	19'-6"	N/A
	NI-70	22'-6"	20'-10"	19'-11"	N/A	23'-0"	21'-5"	20'-5"	N/A
	NI-80	22'-9"	21'-1"	20'-1"	N/A	23'-3"	21'-7"	20'-8"	N/A
	NI-90x	23'-4"	21'-8"	20'-8"	N/A	23'-10"	22'-2"	21'-2"	N/A
14"	NI-40x	23'-7"	21'-11"	20'-11"	N/A	24'-3"	22'-7"	21'-7"	N/A
	NI-60	24'-0"	22'-3"	21'-3"	N/A	24'-8"	22'-11"	21'-11"	N/A
	NI-70	25'-3"	23'-4"	22'-3"	N/A	25'-10"	24'-0"	22'-11"	N/A
	NI-80	25'-7"	23'-8"	22'-7"	N/A	26'-2"	24'-4"	23'-2"	N/A
	NI-90x	26'-4"	24'-4"	23'-3"	N/A	26'-10"	24'-11"	23'-9"	N/A
16"	NI-60	26'-5"	24'-6"	23'-4"	N/A	27'-2"	25'-3"	24'-2"	N/A
	NI-70	27'-9"	25'-8"	24'-6"	N/A	28'-5"	26'-5"	25'-2"	N/A
	NI-80	28'-2"	26'-1"	24'-10"	N/A	28'-10"	26'-9"	25'-6"	N/A
	NI-90x	29'-0"	26'-10"	25'-7"	N/A	29'-7"	27'-5"	26'-2"	N/A

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.




Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf
Simple Spans, L/480 Deflection Limit
3/4" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-10"	15'-0"	14'-5"	13'-5"	16'-4"	15'-5"	14'-6"	13'-5"
	NI-40x	17'-0"	16'-0"	15'-5"	14'-9"	17'-5"	16'-5"	15'-10"	15'-2"
	NI-60	17'-2"	16'-2"	15'-7"	14'-11"	17'-6"	16'-7"	15'-11"	15'-3"
	NI-70	18'-0"	16'-11"	16'-3"	15'-7"	18'-5"	17'-3"	16'-7"	15'-11"
	NI-80	18'-3"	17'-1"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	16'-1"
11-7/8"	NI-20	17'-10"	16'-10"	16'-2"	15'-6"	18'-6"	17'-4"	16'-9"	16'-1"
	NI-40x	19'-4"	17'-11"	17'-3"	16'-6"	19'-11"	18'-6"	17'-9"	17'-0"
	NI-60	19'-7"	18'-2"	17'-5"	16'-9"	20'-2"	18'-9"	17'-11"	17'-2"
	NI-70	20'-9"	19'-2"	18'-3"	17'-5"	21'-4"	19'-9"	18'-10"	17'-10"
	NI-80	21'-1"	19'-5"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
14"	NI-90x	21'-8"	20'-0"	19'-1"	18'-0"	22'-2"	20'-6"	19'-6"	18'-6"
	NI-40x	21'-5"	19'-10"	18'-11"	17'-11"	22'-1"	20'-6"	19'-7"	18'-7"
	NI-60	21'-10"	20'-2"	19'-3"	18'-2"	22'-5"	20'-10"	19'-11"	18'-10"
	NI-70	23'-0"	21'-3"	20'-3"	19'-2"	23'-8"	21'-11"	20'-10"	19'-9"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
15"	NI-90x	24'-1"	22'-3"	21'-2"	20'-0"	24'-8"	22'-10"	21'-9"	20'-7"
	NI-60	23'-9"	22'-0"	20'-11"	19'-10"	24'-6"	22'-9"	21'-8"	20'-6"
	NI-70	25'-1"	23'-2"	22'-0"	20'-10"	25'-9"	23'-10"	22'-9"	21'-6"
	NI-80	25'-6"	23'-6"	22'-4"	21'-2"	26'-1"	24'-2"	23'-1"	21'-10"
	NI-90x	26'-4"	24'-3"	23'-1"	21'-10"	26'-11"	24'-11"	23'-8"	22'-5"
Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-10"	15'-5"	14'-6"	13'-5"	16'-10"	15'-5"	14'-6"	13'-5"
	NI-40x	18'-8"	17'-2"	16'-3"	15'-2"	18'-10"	17'-2"	16'-3"	15'-2"
	NI-60	18'-11"	17'-6"	16'-6"	15'-5"	19'-2"	17'-6"	16'-6"	15'-5"
	NI-70	20'-0"	18'-7"	17'-9"	16'-7"	20'-5"	18'-11"	17'-10"	16'-7"
	NI-80	20'-3"	18'-10"	17'-11"	16'-10"	20'-8"	19'-3"	18'-2"	16'-10"
11-7/8"	NI-20	20'-1"	18'-5"	17'-5"	16'-2"	20'-1"	18'-5"	17'-5"	16'-2"
	NI-40x	21'-10"	20'-4"	19'-4"	17'-8"	22'-5"	20'-6"	19'-4"	17'-8"
	NI-60	22'-1"	20'-7"	19'-7"	18'-4"	22'-8"	20'-10"	19'-8"	18'-4"
	NI-70	23'-4"	21'-8"	20'-8"	19'-7"	23'-10"	22'-3"	21'-2"	19'-9"
	NI-80	23'-7"	21'-11"	20'-11"	19'-9"	24'-1"	22'-6"	21'-5"	20'-0"
14"	NI-90x	24'-3"	22'-6"	21'-6"	20'-4"	24'-8"	23'-0"	22'-0"	20'-9"
	NI-40x	24'-5"	22'-9"	21'-8"	19'-5"	25'-1"	23'-2"	21'-9"	19'-5"
	NI-60	24'-10"	23'-1"	22'-0"	20'-10"	25'-6"	23'-8"	22'-4"	20'-10"
	NI-70	26'-1"	24'-3"	23'-2"	21'-10"	26'-8"	24'-11"	23'-9"	22'-4"
	NI-80	26'-6"	24'-7"	23'-5"	22'-2"	27'-1"	25'-3"	24'-1"	22'-9"
16"	NI-90x	27'-3"	25'-4"	24'-1"	22'-9"	27'-9"	25'-11"	24'-8"	23'-4"
	NI-60	27'-3"	25'-5"	24'-2"	22'-10"	28'-0"	26'-2"	24'-9"	23'-1"
	NI-70	28'-8"	26'-8"	25'-4"	23'-11"	29'-3"	27'-4"	26'-1"	24'-8"
	NI-80	29'-1"	27'-0"	25'-9"	24'-4"	29'-8"	27'-9"	26'-5"	25'-0"
	NI-90x	29'-11"	27'-10"	26'-6"	25'-0"	30'-6"	28'-5"	27'-2"	25'-8"

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.



Maximum Floor Spans



Live Load = 40 psf, Dead Load = 30 psf
Simple Spans, L/480 Deflection Limit
5/8" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-1"	13'-3"	N/A	15'-7"	14'-1"	13'-3"	N/A
	NI-40x	16'-1"	15'-2"	14'-8"	N/A	16'-7"	15'-7"	15'-1"	N/A
	NI-60	16'-3"	15'-4"	14'-10"	N/A	16'-8"	15'-9"	15'-3"	N/A
	NI-70	17'-1"	16'-1"	15'-6"	N/A	17'-5"	16'-5"	15'-10"	N/A
	NI-80	17'-3"	16'-3"	15'-8"	N/A	17'-8"	16'-7"	16'-0"	N/A
11-7/8"	NI-20	16'-11"	16'-0"	15'-5"	N/A	17'-6"	16'-6"	16'-0"	N/A
	NI-40x	18'-1"	17'-0"	16'-5"	N/A	18'-9"	17'-6"	16'-11"	N/A
	NI-60	18'-4"	17'-3"	16'-7"	N/A	19'-0"	17'-8"	17'-1"	N/A
	NI-70	19'-6"	18'-0"	17'-4"	N/A	20'-1"	18'-7"	17'-9"	N/A
	NI-80	19'-9"	18'-3"	17'-6"	N/A	20'-4"	18'-10"	17'-11"	N/A
14"	NI-90x	20'-4"	18'-9"	17'-11"	N/A	20'-10"	19'-3"	18'-5"	N/A
	NI-40x	20'-1"	18'-7"	17'-10"	N/A	20'-10"	19'-4"	18'-6"	N/A
	NI-60	20'-5"	18'-11"	18'-1"	N/A	21'-2"	19'-7"	18'-9"	N/A
	NI-70	21'-7"	20'-0"	19'-1"	N/A	22'-3"	20'-7"	19'-8"	N/A
	NI-80	21'-11"	20'-3"	19'-4"	N/A	22'-7"	20'-11"	20'-0"	N/A
16"	NI-90x	22'-7"	20'-11"	19'-11"	N/A	23'-3"	21'-6"	20'-6"	N/A
	NI-60	22'-3"	20'-8"	19'-9"	N/A	23'-1"	21'-5"	20'-6"	N/A
	NI-70	23'-6"	21'-9"	20'-9"	N/A	24'-3"	22'-5"	21'-5"	N/A
	NI-80	23'-11"	22'-1"	21'-1"	N/A	24'-8"	22'-10"	21'-9"	N/A
	NI-90x	24'-8"	22'-9"	21'-9"	N/A	25'-4"	23'-5"	22'-4"	N/A

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-1"	13'-3"	N/A	15'-7"	14'-1"	13'-3"	N/A
	NI-40x	17'-9"	16'-1"	15'-1"	N/A	17'-9"	16'-1"	15'-1"	N/A
	NI-60	18'-1"	16'-4"	15'-4"	N/A	18'-1"	16'-4"	15'-4"	N/A
	NI-70	19'-2"	17'-10"	16'-9"	N/A	19'-7"	17'-10"	16'-9"	N/A
	NI-80	19'-5"	18'-0"	17'-1"	N/A	19'-10"	18'-3"	17'-1"	N/A
11-7/8"	NI-20	18'-9"	17'-0"	16'-0"	N/A	18'-9"	17'-0"	16'-0"	N/A
	NI-40x	21'-0"	19'-3"	17'-9"	N/A	21'-3"	19'-3"	17'-9"	N/A
	NI-60	21'-4"	19'-8"	18'-5"	N/A	21'-8"	19'-8"	18'-5"	N/A
	NI-70	22'-6"	20'-10"	19'-11"	N/A	23'-0"	21'-4"	20'-0"	N/A
	NI-80	22'-9"	21'-1"	20'-1"	N/A	23'-3"	21'-7"	20'-5"	N/A
14"	NI-90x	23'-4"	21'-8"	20'-8"	N/A	23'-10"	22'-2"	21'-2"	N/A
	NI-40x	23'-7"	21'-5"	19'-6"	N/A	24'-1"	21'-5"	19'-6"	N/A
	NI-60	24'-0"	22'-3"	21'-0"	N/A	24'-8"	22'-5"	21'-0"	N/A
	NI-70	25'-3"	23'-4"	22'-3"	N/A	25'-10"	24'-0"	22'-9"	N/A
	NI-80	25'-7"	23'-8"	22'-7"	N/A	26'-2"	24'-4"	23'-2"	N/A
16"	NI-90x	26'-4"	24'-4"	23'-3"	N/A	26'-10"	24'-11"	23'-9"	N/A
	NI-60	26'-5"	24'-6"	23'-4"	N/A	27'-2"	24'-10"	23'-4"	N/A
	NI-70	27'-9"	25'-8"	24'-6"	N/A	28'-5"	26'-5"	25'-2"	N/A
	NI-80	28'-2"	26'-1"	24'-10"	N/A	28'-10"	26'-9"	25'-6"	N/A
	NI-90x	29'-0"	26'-10"	25'-7"	N/A	29'-7"	27'-5"	26'-2"	N/A

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.

1W-1

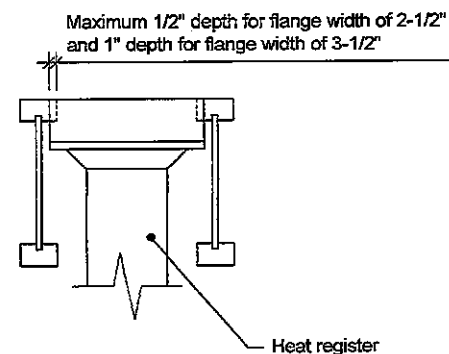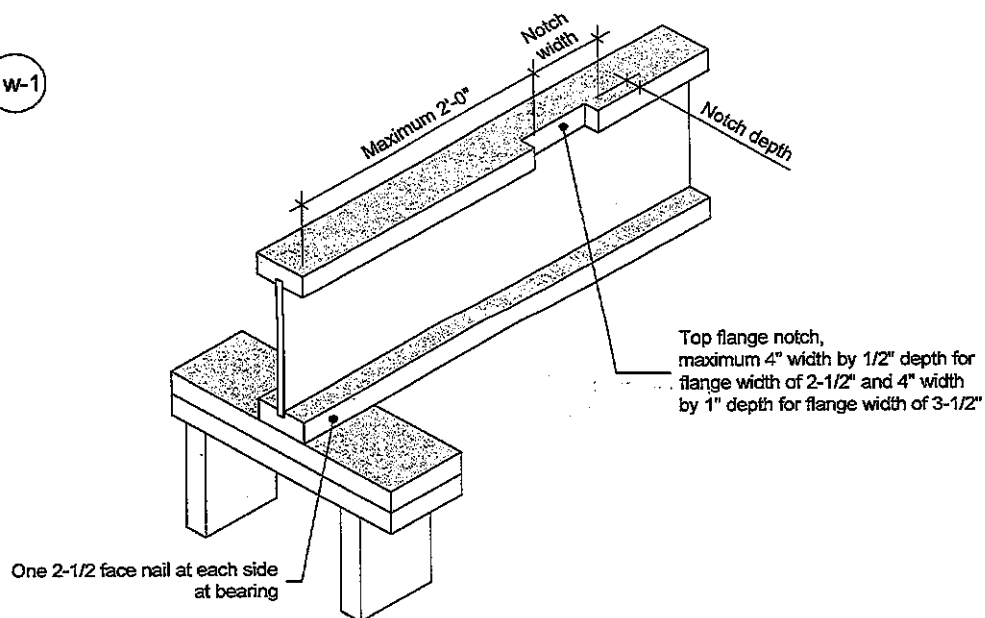

Notes:

1. Blocking required at bearing for lateral support, not shown for clarity.
2. The maximum dimensions for a notch on the side of the top flange are 4-inch width by 1/2-inch depth for flange width of 2-1/2 inches, and 4-inch width by 1-inch depth for flange width of 3-1/2 inches.
3. This detail applies to simple-span joists and multiple-span joists where the notch is located at the end half-span.
4. For other applications, contact Nordic Structures.

This document supersedes all previous versions. If the document has been in effect for more than one year, consult nordic.ca or contact Nordic Structures.

All nails shown in the details are assumed to be common nails unless otherwise noted. Nails shall have a diameter not less than 0.126 inch for 2-1/2-inch nails, or 0.144 inch for 3-inch nails. Individual components not shown to scale for clarity.

**NORDIC
STRUCTURES**

T 514-871-8526
1 866 817-3418
nordic.ca

TITLE
Notch in I-joist for Heat Register

CATEGORY
I-joist - Typical Floor Framing and Construction Details

DOCUMENT

-

DATE

2018-04-10

NUMBER

1W-1




Allowance for Piping (Installation Notes)

The floor layouts have usually not been checked for heating and/or plumbing interference. On-site adjustment of joists of up to 3 inches is permitted to avoid interferences. When moving a joist, the subfloor thickness shall be checked with code requirements when the joist spacing exceeds 19.2 inches. Except for cutting to length, I-joist flanges should never be cut, drilled, or notched.

Installation of Nordic I-joists shall be as per *Nordic Joist Installation Guide for Residential Floors*. Refer to Tables 1 and 2 for maximum web hole and duct chase openings, respectively. These tables are based on the I-joists being used at their maximum spans. The minimum distance given may be reduced for shorter spans; contact your distributor for additional information.

The detail below shows the 3-inch allowance for piping. Every third joist may be shifted up to 3 inches to avoid heating/plumbing interference. For other applications, please contact your distributor.

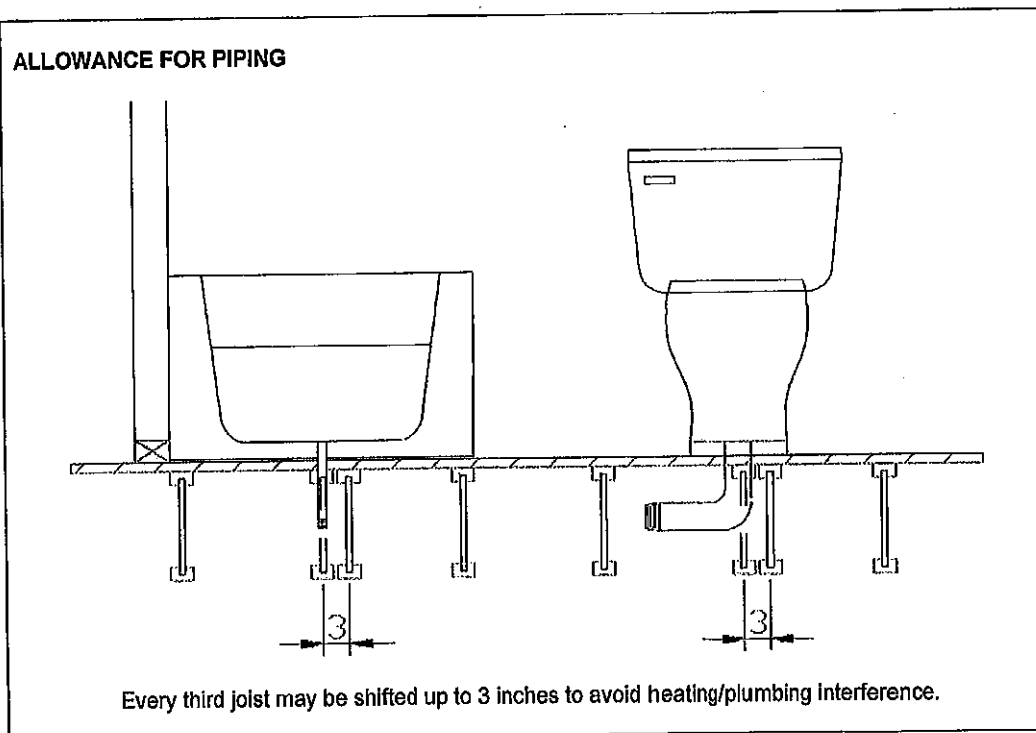

Revised April 12, 2012