

CONSTRUCTION NOTES (Unless otherwise noted)

ALL CONSTRUCTION TO ADHERE TO THESE PLANS AND SPEC'S AND TO CONFORM TO THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE CODES AND AUTHORITIES HAVING JURISDICTION. THESE REQUIREMENTS ARE TO BE TAKEN AS MINIMUM SPECIFICATIONS. ONT. REG. 332/12-2012 OBC.

1. ROOF CONSTRUCTION

NO.210 (10.25kg/m²) ASPHALT SHINGLES, 10mm (3/8") PLYWOOD SHEATHING WITH "H" CUPS. APPROVED WOOD TRUSSES @ 610mm (24") O.C. MAX. APPROVED EAVES PROTECTION TO EXTEND 900mm (3'-0") FROM EDGE OF ROOF AND MIN. 300mm (12") BEYOND INNER FACE OF EXTERIOR WALL. (EAVES PROTECTION NOT REQ'D FOR ROOF SLOPES 8:12 OR GREATER) 38x89 (2"x4") TRUSS BRACING @ 1830mm (6'-0") O.C. AT BOTTOM CHORD. PREFIN. ALUM. CAVESTROUGH, FASCIA, RAIL & VENTED SOFFIT. PROVIDE ICE & WATER SHEILD TO ALL ROOF/WALL SURFACES SUSCEPTIBLE TO ICE DAMMING. ROOF SHEATHING TO BE FASTENED 150 (6") c/c ALONG EDGES & INTERMEDIATE SUPPORTS WHEN TRUSSES SPACED GREATER THAN 406 (16"). ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH MIN. 25% AT EAVES & MIN. 25% AT RIDGE (OBC 9.19.1.2).

2. FRAME WALL CONSTRUCTION (2"x6") (SB-12-TABLE 3.1.1.2.A)
SIDING AS PER ELEV., 19x38 (1"x2") VERTICAL WOOD FURRING, CONTIN. SHEATHING MEMBRANE, 11mm (7/16") EXT. TYPE SHEATHING OR OBC COMPLIANT EQUIVALENT, 38x140 (2"x6") STUDS @ 406mm (16") O.C., RSI 3.87 (R22) INSULATION AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm (1/2") INT. DRYWALL FINISH. SIDING TO BE MIN. 200mm (8") ABOVE FINISH GRADE. REFER TO OBC SB-12, CHAPTER 3 FOR REQUIRED MINIMUM THERMAL INSULATION REQUIREMENTS.

2B. FRAME WALL CONSTRUCTION (2"x4") - GARAGE WALLS
SIDING AS PER ELEV., 19x38 (1"x2") VERTICAL WOOD FURRING, CONTIN. SHEATHING MEMBRANE, 11mm (7/16") EXT. TYPE SHEATHING OR OBC COMPLIANT EQUIVALENT, 38x89 (2"x4") STUDS @ 406mm (16") O.C. (MAX. HEIGHT 3000mm (9'-10")), WITH APPR. DIAGONAL WALL BRACING. REFER TO NOTE 19 WHERE FLOOR EXISTS ABOVE GARAGE. SIDING TO BE MIN. 200mm (8") ABOVE FINISH GRADE.

2C. STUCCO WALL CONSTRUCTION (2"x6") (SB-12-TABLE 3.1.1.2.A)
STUCCO CLADDING SYSTEM CONFORMING TO O.B.C. 9.27.1.1.(2) & 9.28 THAT EMPLOY A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED PER MANUFACTURERS SPECIFICATIONS ON 25mm (1") MIN. EXTRUDED OR EXPANDED RIGID POLYSTYRENE ON APPR. AIR/MOISTURE BARRIER ON 38x140 (2"x6") STUDS @ 406 (16") O.C., RSI 3.87 (R22) BATT INSUL., APPR. 6 MIL. POLYETHYLENE VAPOUR BARRIER, 13mm (1/2") GYPSUM BOARD INTERIOR FINISH. STUCCO TO BE MIN. 200 (8") ABOVE FINISH GRADE. REFER TO OBC SB-12, CHAPTER 3 FOR REQUIRED MINIMUM THERMAL INSULATION REQUIREMENTS.

2D. STUCCO WALL CONSTRUCTION (2"x4") - GARAGE WALLS
STUCCO CLADDING SYSTEM CONFORMING TO O.B.C. 9.27.1.1.(2) & 9.28 THAT EMPLOY A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED PER MANUFACTURERS SPECIFICATIONS ON 25mm (1") MIN. EXTRUDED OR EXPANDED RIGID POLYSTYRENE ON APPR. AIR/MOISTURE BARRIER ON 38x89 (2"x4") STUDS @ 406 (16") O.C. (MAX. HEIGHT 3000mm (9'-10")), WITH APPR. DIAGONAL WALL BRACING. REFER TO NOTE 19 WHERE FLOOR EXISTS ABOVE GARAGE. STUCCO TO BE MIN. 200 (8") ABOVE FINISH GRADE.

2E. WALLS ADJACENT TO ATTIC - NO CLADDING
11mm (7/16") EXT. TYPE SHEATHING OR OBC COMPLIANT EQUIVALENT, 38x140 (2"x6") STUDS @ 406mm (16") O.C., RSI 3.87 (R22) INSULATION AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm (1/2") INTERIOR DRYWALL FINISH. MID-HEIGHT BLOCKING REQ'D. IF NO SHEATHING APPLIED, REFER TO OBC SB-12, CHAPTER 3 FOR ADDITIONAL THERMAL INSULATION REQUIREMENTS.

3. BRICK VENEER CONSTRUCTION (2"x6") (SB-12-TABLE 3.1.1.2.A)
90mm (4") FACE BRICK, 25mm (1") AIR SPACE, 22x180x76mm (7/8"x4"x3") GVL. METAL TIES @ 406mm (16") O.C. HORIZONTAL 610mm (24") O.C. VERTICAL. APPROVED SHEATHING PAPER, 11mm (7/16") EXTERIOR TYPE SHEATHING OR OBC COMPLIANT EQUIVALENT, 38x140 (2"x6") STUDS @ 406mm (16") O.C., RSI 3.87 (R22) INSULATION AND APPR. VAPOUR BARRIER WITH APPROVED CONTIN. AIR BARRIER, 13mm (1/2") INTERIOR DRYWALL FINISH. PROVIDE WEEP HOLES @ 800mm (32") O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER. BRICK TO BE MIN. 150mm (6") ABOVE FINISH GRADE. REFER TO OBC SB-12, CHAPTER 3 FOR REQUIRED MINIMUM THERMAL INSULATION REQUIREMENTS.

3B. BRICK VENEER CONSTRUCTION (2"x4") - GARAGE WALLS
90mm (4") FACE BRICK, 25mm (1") AIR SPACE, 22x180x76mm (7/8"x4"x3") GVL. METAL TIES @ 406mm (16") O.C. HORIZONTAL 610mm (24") O.C. VERTICAL. APPROVED SHEATHING PAPER, 11mm (7/16") EXTERIOR TYPE SHEATHING OR OBC COMPLIANT EQUIVALENT, 38x89 (2"x4") STUDS @ 406mm (16") O.C. (MAX. HEIGHT 3000mm (9'-10")) WITH APPROVED DIAGONAL WALL BRACING. REFER TO NOTE 19 WHERE FLOOR EXISTS ABOVE GARAGE. PROVIDE WEEP HOLES @ 800mm (32") O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER. BRICK TO BE MIN. 150mm (6") ABOVE FINISH GRADE.

3C. STUCCO WALL CONSTRUCTION (2"x4") (SB-12-TABLE 3.1.1.2.A)
STUCCO CLADDING SYSTEM CONFORMING TO O.B.C. 9.27.1.1.(2) & 9.28 THAT EMPLOY A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED PER MANUFACTURERS SPECIFICATIONS ON 25mm (1") MIN. EXTRUDED OR EXPANDED RIGID POLYSTYRENE ON APPR. CONTIN. AIR/MOISTURE BARRIER ON 38x140 (2"x6") STUDS @ 406mm (16") O.C., RSI 3.87 (R22) BATT INSUL., APPR. 6 MIL. POLYETHYLENE VAPOUR BARRIER, 13mm (1/2") GYPSUM BOARD INTERIOR FINISH. STUCCO TO BE MIN. 200 (8") ABOVE FINISH GRADE. REFER TO OBC SB-12, CHAPTER 3 FOR REQUIRED MINIMUM THERMAL INSULATION REQUIREMENTS.

INTERIOR STUD PARTITIONS

4. FOR BEARING PARTITIONS 38x89 (2"x4") @ 406mm (16") O.C. FOR 2 STOREYS AND 305mm (12") O.C. FOR 3 STOREYS. NON-BEARING PARTITIONS 38x89 (2"x4") @ 610mm (24") O.C. PROVIDE 38x89 (2"x4") BOTTOM PLATE AND 2/38x89 (2"x4") TOP PLATE, 13mm (1/2") INT. DRYWALL BOTH SIDES OF STUDS. PROVIDE 38x140 (2"x6") STUDS/PLATES WHERE NOTED.

5. FOUNDATION WALL/FOOTINGS (9.15.3, 9.15.4, 9.13.2, 9.14.2, 9.12.1)
200mm (8") POURED CONC. FDN. WALL 15MPa (2200psi) WITH BITUMINOUS DAMPROOFING AND DRAINAGE LAYER. DRAINAGE LAYER REQ'D. WHEN BASEMENT INSUL. EXTENDS 900 (2'-11") BELOW FIN. GRADE. DRAINAGE LAYER IS NOT REQ'D. IF FOUNDATION WALL IS WATERPROOFED. MAXIMUM FOUR HEIGHT 2350 (7'-10") ON 500x155 (2"x6") CONTINUOUS REIN. CONC. FIG. BRACE FDN. WALL PRIOR TO BACKFILLING. ALL FOOTINGS SHALL REST ON NATURAL UNDISTURBED SOIL OR COMPACTED ENGINEERED FILL.

STRIP FOOTINGS - FOR TOWNHOUSES

FOR STRIP FOOTING SIZES REFER TO BLOCK FOUNDATION PLAN. ASSUMED 120 kPa (18 psi) SOIL BEARING CAPACITY FOR TOWNHOUSES. TO BE VERIFIED ON SITE.

-MAXIMUM FLOOR LIVE LOAD OF 2.4kPa. (50psf) PER FLOOR.
-REFER TO SOILS REPORT FOR SOIL CONDITIONS AND BEARING CAPACITY.

FOUNDATION DRAINAGE OBC 9.14.2 & 9.14.3

100mm (4") DIA. FOUNDATION DRAINAGE TILE 150mm (6") CRUSHED STONE OVER AND AROUND DRAINAGE TILES.

7. BASEMENT SLAB OBC 9.3.1.6(1)(b), 9.16.4.5(1), 9.29.3.3(15)

80mm (3") MIN. 25MPa (3600psi) CONC. SLAB ON 100mm (4") COARSE GRANULAR FILL, OR 20MPa (3000psi) CONC. WITH DAMPROOFING BELOW SLAB UNDER SLAB INSULATION PER SB-12, 3.1.1.7.5(6) where required.
ALL SLAB JOINTS & PENETRATIONS TO BE SEALED TO PREVENT AIR BARRIER.

8. WOOD SUBFLOORS (SEE OBC 9.23.1.4 & 9.30.2.1)

-19mm (3/4") MIN. T & C SUBFLOOR UNDER GROUND FLOOR FINISH FLOOR.
16mm (5/8") T&C SUBFLOOR UNDER SECOND FLOOR FINISH FLOOR.
16mm (5/8") PANEL-TYPE UNDERLAY FOR CERAMIC TILE APPLICATION.
6mm (1/4") PANEL-TYPE UNDERLAYMENT UNDER RESILIENT & PARQUET FLOORING.

9. ATTIC INSULATION (SB-12-TABLE 3.1.1.2.A) (SB-12-3.1.1.8)

RSI 10.56 (R60) BLOWN IN ROOF INSULATION AND APPROVED VAPOUR BARRIER, 16mm (5/8") INT. DRYWALL FINISH OR APPROVED EQUAL. RSI 3.52 (R20) MIN. ABOVE INNER SURFACE OF EXTERIOR WALL.

10. ALL STAIRS/EXTERIOR STAIRS - OBC 9.8 -

UNIFORM RISE
5mm (1/4") MAX. BETWEEN ADJACENT TREADS OR LANDINGS
10mm (1/2") MAX. BETWEEN TALLEST & SHORTEST RISE IN FLIGHT

MAX. RISE = 200 (7'-7/8")
MIN. RUN = 210 (8'-1/4")
MIN. TREAD = 235 (9'-1/4")
MAX. NOSING = 25 (1")
MIN. HEADROOM = 1950 (6'-5")
RAIL @ LANDING = 900 (2'-11")
RAIL @ STAIR = 865 (2'-10") TO 955 (3'-2")
MIN. STAIR WIDTH = 860 (2'-10")

FOR CURVED STAIRS

MIN. RUN = 150 (6")
MIN. AVG. RUN = 200 (8")

HANDRAILS - OBC 9.8.7 -

FINISHED RAILING ON PICKETS SPACED MAXIMUM 100mm (4") BETWEEN PICKETS. CLEARANCE BETWEEN HANDRAIL AND SURFACE BEHIND IT TO BE 50 (2") MIN. HANDRAILS TO BE CONTINUOUS EXCEPT FOR NEWEL POST AT CHANGES OF DIRECTION.

INTERIOR GUARDS - OBC 9.8.8 -

INTERIOR GUARDS: 900mm (2'-11") MIN. HIGH
EXTERIOR GUARDS - OBC 9.8.8
900mm (36") HIGH GUARD WHERE DISTANCE FROM PORCH TO FIN. GRADE IS LESS THAN 1800mm (7'-10"). 1070mm (42") HIGH GUARD IS REQUIRED WHERE DISTANCE EXCEEDS 1800mm (7'-10").

SILL PLATE ANCHORAGE

38x89 (2"x4") SILL PLATE WITH 13mm (1/2") DIA. ANCHOR BOLTS 200mm (8") LONG, EMBEDDED MIN. 100mm (4") INTO CONC. @ 2400mm (7'-10") O.C., CALCULATED OR 25 (1") MIN. MINERAL WOOL BETWEEN PLATE AND TOP OF FDN. WALL.
USE NON-SHRINK GROUT TO LEVEL SILL PLATE WHEN REQUIRED.

13. BASEMENT INSULATION (SB-12-3.1.1.7, 9.25.3, 9.13.2.6)

FOUNDATION WALLS ENCLOSING HEATED SPACE SHALL BE INSULATED FROM THE UNDERSIDE OF THE SUBFLOOR TO NOT MORE THAN 200mm (8") ABOVE THE FINISHED FLOOR & NO CLOSER THAN 50mm (2") OF THE BASEMENT SLAB. RSI 3.52 (R20) BLANKET INSULATION TO HAVE APPROVED VAPOUR BARRIER. RECOMMEND DAMPROOF WITH BUILDING PAPER BETWEEN THE FOUNDATION WALL AND INSULATION UP TO GRADE LEVEL. NOTE: FULL HEIGHT INSULATION AT COLD CELLAR WALLS. AIR BARRIER TO BE SEALED TO FOUNDATION WALL WITH CAULKING. CONTINUOUS INSULATION (ci) IS NOT TO BE INTERRUPTED BY FRAMING.

BASEMENT BEARING STUD PARTITION

38x89 (2"x4") STUDS @ 406mm (16") O.C. 38x89 (2"x4") SILL PLATE ON DAMPROOFING MATERIAL. 13mm (1/2") DIA. ANCHOR BOLTS 200mm (8") LONG, EMBEDDED MIN. 100mm (4") INTO CONC. @ 2400mm (7'-10") O.C. 100mm (4") HIGH CONC. CURB ON 305x155 (12"x6") CONC. FOOTING. ADD HORIZ. BLOCKING AT MID-HEIGHT IF WALL IS UNFINISHED.

15. STEEL BASEMENT COLUMN (SEE OBC 9.15.3.3)

89mm (3-1/2") DIA x 4.78mm (0.188") STL. COL. WITH A MIN. CAPACITY OF 103.6kN (24,000lbs) WITH 150x150x5 (6"x6"x3/8") STL. TOP & BOTTOM PLATE.

15A. STEEL COLUMN

90mm (3-1/2") DIA x 4.78mm (0.188") STL. COL. WITH 100x100x6.0 (4"x4"x1/4") TOP & BOTTOM PLATES. FIELD YIELD BOTTOM PLATE TO 100x250x12.5 (4"x10"x1/2") BASE PLATE C/W 2-12mm DIA x 300mm LONG x50mm HOOK ANCHORS (2-1/2"x12"x2"). THE COLUMN TO STUD WALL WITH 2-32x3.175 (1 1/4"x1/8") STEEL STRAP WELDED TO COLUMN AND FASTENED TO STUD WITH 2-505 6.35mm (1/4") DIA. X 150mm (6") BOLTS BY SIMPSON STRONG TIE.

CONCRETE PLASTER

16. BEAM POCKET OR 200x200 (8"x8") POURED CONC. NIB WALLS. MIN. BEARING 90mm (3'-1/2")

17. 19x38 (1"x2") CONTINUOUS WOOD STRAPPING BOTH SIDES OF STEEL BEAM. (OBC 9.23.4.3.(3c))

GARAGE SLAB

18. 100mm (4") 32MPa (4640psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT ON OPTIONAL 100 (4") COARSE GRANULAR FILL WITH COMPACTED SUB-BASE OR COMPACTED FILL. SLOPE TO FRONT (EXTERIOR) AT 1% MIN.

INTERIOR GARAGE WALLS & CEILING (SB-12-TABLE 3.1.1.2.A)

13mm (1/2") GYPSUM BOARD ON WALL AND CEILING BETWEEN HOUSE AND GARAGE. RSI 3.87 (R22) IN WALLS, RSI 5.46 (R31) IN CEILING. TAPE AND SEAL ALL JOINTS AIRTIGHT PER O.B.C. 9.10.9.16. REFER TO SB-12, TABLE 3.1.1.2.A FOR REQUIRED THERMAL INSULATION.

20. DOOR AND FRAME CASHPROFED. DOOR EQUIPPED WITH SELF CLOSING DEVICE AND WEATHERSTRIPPING PER OBC 9.10.13.15.

EXTERIOR STEP

PRECAST CONCRETE STEP OR WOOD STEP WHERE NOT EXPOSED TO WEATHER. MAX. RISE 200mm (7'-7/8") MIN. TREAD 250mm (9'-27/32"). SEE OBC 9.8.9.2, 9.8.9.3 & 9.8.10.

22. DRYER VENT (OBC 9.23.8.(7) & 6.2.4.1.1)
CAPPED DRYER EXHAUST VENTED TO EXTERIOR. (USE 100mm (4") DIA. SMOOTH WALL VENT PIPE).

23. INSULATED ATTIC ACCESS (OBC 9.19.2.1 & SB12-3.1.1.8)

ATTIC ACCESS HATCH WITH MIN. DIMENSION OF 545x700mm (21'-1/2"x27'-1/2") & A MIN. AREA OF 0.32 SQ.M. (3.44 SQ.FT.) WITH WEATHERSTRIPPING. RSI 3.52 (R20) RIGID INSULATION BACKING. SEE OBC SB-12, 3.1.1.8.

24. FIREPLACE CHIMNEYS - OBC 9.21 -

TOP OF FIREPLACE CHIMNEY SHALL BE 910mm (3'-0") ABOVE THE HIGHEST POINT AT WHICH IT COMES IN CONTACT WITH THE ROOF AND 610mm (2'-0") ABOVE THE ROOF SURFACE WITHIN A HORIZ. DISTANCE OF 3050mm (10'-0") FROM THE CHIMNEY.

25. LINEN CLOSETS

4 SHELVES MIN. 350mm (14") DEEP.

26. MECHANICAL EXHAUST

MECHANICAL EXHAUST FAN, VENTED TO EXTERIOR AS REQUIRED BY OBC 9.32.3.5, & 9.32.3.10.

27. STEEL BEARING PLATE FOR MASONRY WALLS

280x280x16 (11"x11"x5/8") STL. PLATE FOR ST. BEAMS AND 280x280x12 (11"x11"x1/2") STL. PLATE FOR WOOD BEAMS BEARING ON CONC. BLOCK PARTYWALL, ANCHORED WITH 2-19mm (3/4") x 200mm (8") LONG GALV. ANCHORS WITHIN SOLID BLOCK COURSE. LEVEL WITH NON-SHRINK GROUT.

27A. SOLID WOOD BEARING FOR WOOD STUD WALLS

SOLID BEARING TO BE AT LEAST AS WIDE AS THE SUPPORTED MEMBER. SOLID WOOD BEARING COMPRISED OF BUILT-UP WOOD STUDS TO BE CONSTRUCTED IN ACCORDANCE WITH OBC 9.17.4.2(2).

28. CLASS 'B' VENT

U.L.C. RATED CLASS 'B' VENT 610mm (2'-0") ABOVE THE POINT IN CONTACT WITH THE ROOF FOR SLOPES UP TO 9/12, REFER TO THE ONTARIO GAS UTILIZATION CODE.

29. BASEMENT WOOD POST (OBC 9.17.4)

3-38x140 (3'-2"x4") BUILT-UP POST ON BEHM BASE SHOE ANCHORED TO CONC. WITH 12.7 DIA. 405x405x203 (16"x16"x8") CONC. FIG. OR AS OTHERWISE SPECIFIED ON DRAWING.

30. STEPPED FOOTINGS (OBC 9.15.3.9)

MIN. HORIZ. STEP = 600mm (24")
MAX. VERT. STEP = 600mm (24")

31. SLAB ON GRADE

MIN. 100mm (4") CONCRETE SLAB ON GRADE ON 100mm (4") COARSE GRANULAR FILL. REINFORCED WITH 6x6-W2.6Wx2.9 MESH PLACED NEAR MID-DEPTH OF SLAB. CONC. STRENGTH 32 MPa (4640 psi) WITH 5-8% AIR ENTRAINMENT ON COMPACTED SUB-BASE. UNDER SLAB INSULATION AS PER OBC SB-12 3.1.1.7.5(6) AND SB-12, TABLE 3.1.1.2.A, where required.
ALL JOINTS & PENETRATIONS OF INTERIOR SLABS TO BE SEALED TO PREVENT AIR BARRIER.

LOOSE STEEL UNITS

L1 = 3-1/2" x 3-1/2" x 1/4" (90x90x6.0)
L2 = 4" x 3-1/2" x 5/16" (100x90x8.0)
L3 = 5" x 3-1/2" x 5/16" (125x90x8.0)
L4 = 6" x 3-1/2" x 3/8" (150x90x10.0)
L5 = 6" x 4" x 3/8" (150x100x10.0)
L6 = 7" x 4" x 3/8" (180x100x10.0)

LAMINATED VENEER LUMBER (LVL) BEAMS

LVL1A = 1-1/2" x 3/4" x 1/4" (1-45x184)
LVL1 = 2-1/2" x 3/4" x 1/4" (2-45x184)
LVL2 = 3-1/2" x 3/4" x 1/4" (3-45x184)
LVL3 = 4-1/2" x 3/4" x 1/4" (4-45x184)
LVL4A = 1-1/2" x 3/4" x 1/4" (1-45x235)
LVL4 = 2-1/2" x 3/4" x 1/4" (2-45x235)
LVL5 = 3-1/2" x 3/4" x 1/4" (3-45x235)
LVL5A = 4-1/2" x 3/4" x 1/4" (4-45x235)
LVL6A = 1-1/2" x 3/4" x 1/4" (1-45x330)
LVL6 = 2-1/2" x 3/4" x 1/4" (2-45x330)
LVL7 = 3-1/2" x 3/4" x 1/4" (3-45x330)
LVL7A = 4-1/2" x 3/4" x 1/4" (4-45x330)
LVL8 = 2-1/2" x 3/4" x 1/4" (2-45x356)
LVL9 = 3-1/2" x 3/4" x 1/4" (3-45x356)

BRICK VENEER LINTELS

WL1 = 3-1/2" x 3-1/2" x 1/4" (90x90x6.0)
WL2 = 4" x 3-1/2" x 5/16" (100x90x8.0)
WL3 = 5" x 3-1/2" x 5/16" (125x90x8.0)
WL4 = 6" x 3-1/2" x 7/16" (150x90x11.0)
WL5 = 6" x 4" x 7/16" (150x100x11.0)
WL6 = 5" x 3-1/2" x 5/16" (125x90x8.0)
WL7 = 5" x 3-1/2" x 5/16" (125x90x8.0)
WL8 = 5" x 3-1/2" x 5/16" (125x90x8.0)
WL9 = 6" x 4" x 7/16" (150x100x11.0)

WOOD LINTELS AND BEAMS

WB1 = 2-2"x8" (2-38x184) SPR. No.2
WB2 = 3-2"x8" (3-38x184) SPR. No.2
WB3 = 4-2"x8" (4-38x184) SPR. No.2
WB4 = 3-2"x10" (3-38x235) SPR. No.2
WB5 = 4-2"x10" (4-38x235) SPR. No.2
WB6 = 3-2"x12" (3-38x286) SPR. No.2
WB7 = 4-2"x12" (4-38x286) SPR. No.2
WB8 = 5-2"x12" (5-38x286) SPR. No.2
WB9 = 3-2"x10" (3-38x235) SPR. No.2
WB10 = 4-2"x12" (4-38x286) SPR. No.2

DIRECT VENTING GAS FURNACE VENT

DIRECT VENT FURNACE TERMINAL MIN. 900mm (36") FROM A GAS REGULATOR, MIN. 300mm (12") ABOVE FIN. GRADE, FROM ALL OPENINGS, EXHAUST AND INTAKE VENTS. AIR INTAKE TO BE A MIN. OF 1830mm (6'-0") FROM ALL EXHAUST TERMINALS. REFER TO GAS UTILIZATION CODE. ALL AIR INTAKES SHALL BE LOCATED SO THAT THEY ARE SEPARATED FROM KITCHEN EXHAUST BY 3.0M IN COMPLIANCE WITH O.B.C. DIV-B TABLE 6.2.3.12.

DIRECT VENTING GAS FIREPLACE VENT

DIRECT VENT GAS FIREPLACE. VENT TO BE A MINIMUM 300mm (12") FROM ANY OPENING AND ABOVE FIN. GRADE. REFER TO GAS UTILIZATION CODE.

JOIST STRAPPING AND BRIDGING (SEE OBC 9.23.8.4)

16mm (5/8") T & C SUBFLOOR ON WOOD FLOOR JOISTS. FOR CERAMIC TILE APPLICATION (SEE OBC 9.30.6.9) 6mm (1/4") PANEL TYPE UNDERLAY UNDER RESILIENT & PARQUET FLOORING. (SEE OBC 9.30.2.2)

FLOOR JOISTS WITH SPANS OVER 2100mm (6'-11") TO BE BRIDGED WITH 38x89 (2"x4") CROSS BRACING OR SOLID BLOCKING @ 2100mm (6'-11") O.C. MAX. AND WHERE SPECIFIED BY JOIST TABLES A-1 OR A-2 STRAPPING SHALL BE 19x64 (1"x3") @ 2100mm (6'-11") O.C. UNLESS A PANEL TYPE CEILING FINISH IS APPLIED. (SEE OBC 9.23.8.4.9)

EXPOSED BUILDING FACE - OBC 9.10.15

EXTERIOR WALLS TO HAVE A FIRE RESISTANCE RATING OF NOT LESS THAN 45 min. WHERE LIMITING DISTANCE (LD) IS LESS THAN 1.2M (3'-11"). WHERE THE LD IS LESS THAN 600mm (1'-11") THE EXPOSING FACE SHALL BE CLAD IN NON-COMBUSTIBLE MATERIAL. SEE ELEVATIONS FOR ADDITIONAL NOTES.

COLD CELLAR PORCH SLAB (OBC 9.38.1)


FOR MAX. 2500 mm (8'-2") PORCH DEPTH (SHORTEST DIM.), 125mm (4") 32MPa (4640psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT. REIN. WITH 10M BARS @ 230mm (7") O.C. EACH WAY IN BOTTOM THIRD OF SLAB. 60x60x60 (23 5/8" x 23 5/8" x 23 5/8") 10M DOWELS @ 600mm (23 5/8") O.C., ANCHORED IN PERIMETER FDT. WALLS. SLOPE SLAB MIN. 1.0% FROM DOOR. SLAB TO HAVE MIN 75mm (3") BEARING ON FDN. WALLS. PROVIDE (1) UNTELS OVER CELLAR DOOR AND WITH 100mm (4") END BEARING.

BRICK CHECK


THE FDN. WALL SHALL NOT BE REDUCED TO LESS THAN 90mm (3'-1/2") THICK TO A MAX. DEPTH OF 600mm (26") AND SHALL BE TIED TO THE FACING MATERIAL WITH METAL TIES SPACED 200mm (8") O.C. VERTICALLY AND 500mm (36") O.C. HORIZONTALLY. FILL SPACE BETWEEN WALL AND FACING SOLID WITH MORTAR.

CONVENTIONAL ROOF FRAMING (2.0kPa. SNOW LOAD)

38x140 (2"x6") RAFTERS @ 406mm (16") O.C. FOR MAX 11'-7" SPAN, 38x184 (2"x8") RIDGE BOARD. 38x89 (2"x4") COLLAR TIES AT MIDSPANS. CEILING JOISTS TO BE 38x89 (2"x4") @ 406mm (16") O.C. FOR MAX. 2830mm (9'-3") SPAN & 38x140 (2"x6") @ 406 (16") O.C. FOR MAX. 4450mm (14'-7") SPAN.
RAFTERS FOR BUILT-UP ROOF TO BE 38x89 (2"x4") @ 610mm (24

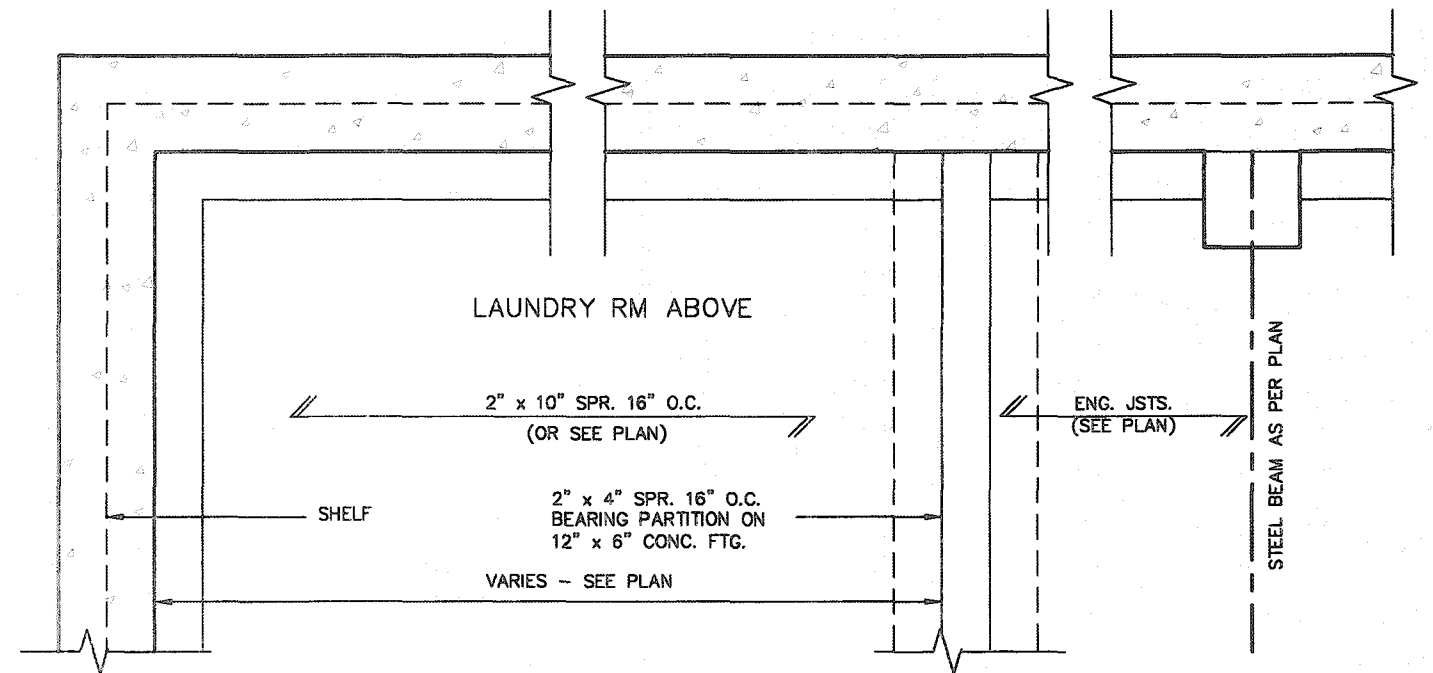

PARTIAL FOUNDATION PLAN

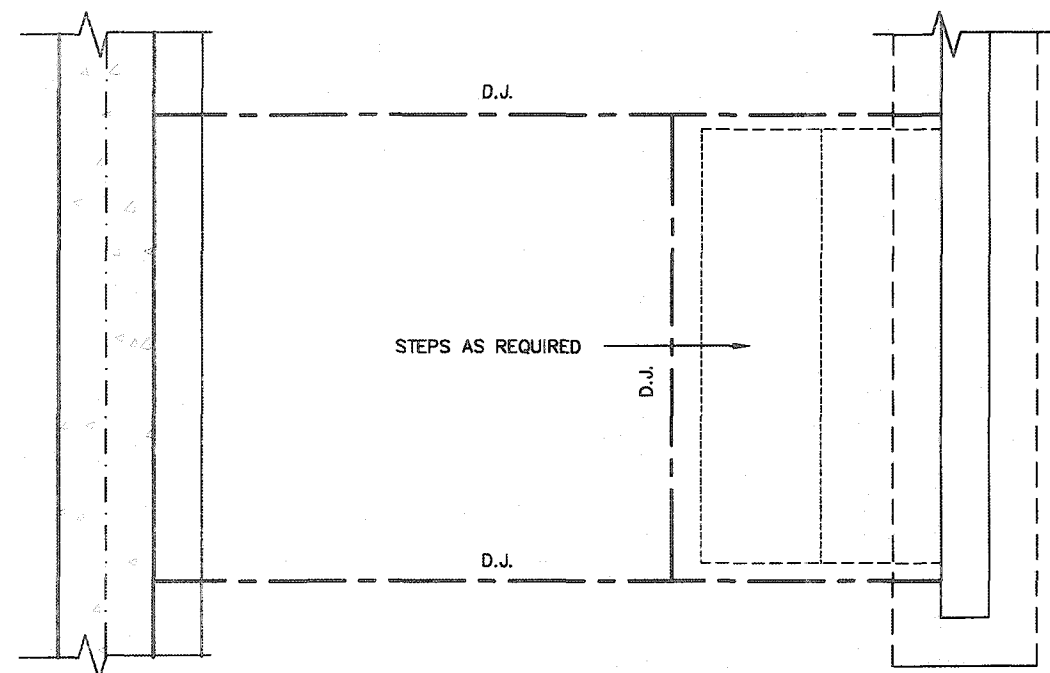

CITY OF HAMILTON
Building Division

Permit No. 21-107197

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE


THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAWS

These drawings and/or specifications have been reviewed by

CXW 04/09/21

FINESLAND BUILDING OFFICIAL DATE

STRUDET INC.

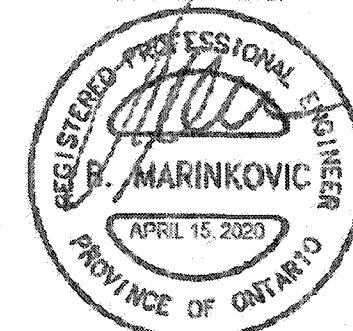

FOR STRUCTURE ONLY

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department

FEB 9 2021

REC'D BY _____ DATE _____
REF'D TO _____ DATE _____

CONC. FOOTING C/W FORMED KEYWAY ON
NATURAL UNDISTURBED SOIL. FOR SIZES
SEE ARCHITECTURAL DRAWINGS.

		-	The undersigned has reviewed and takes responsibility for this design and lists the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.
9		-	qualification information
8		-	Richard Vink R Vink 2448
7		-	comp signature BC
6		-	registration information
5		-	VAS Design Inc. 4265
4		-	
3		-	Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be copied.
2		-	
1	ISSUED FOR PERMIT.	APR 13/20 GW	
no.	description	date by	

VA3

DESIGN

255 Consumers Rd Suite 120
Toronto ON M2J 1R4
t 416.630.2255 f 416.630.4782
va3design.com




SINGLES

project name RUSSELL GARDENS PH. 3	municipality WATERDOWN	project no. 19014
date APRIL 2020		drawing no. 2
drawn by GW checked by - scale Not to Scale		SUNKEN FLOOR DETAILS fine name 19014-GF-STD_DETAILS_A1

All drawings specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.

REC'D BY _____ DATE _____
REF'D TO _____ DATE _____

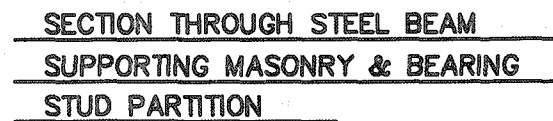Permit No. 21-107197

These drawings and/or specifications have been reviewed by

FOR CHIEF BUILDING OFFICIAL

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.

qualification information

Richard Vink	2448
name	BC
signature	
registration information	
VAS Design Inc.	4265

255 Consumers Rd Suite 120
Toronto ON M2J 1R4
t 416.630.2255 f 416.630.4776
va3design.com

project name
RUSSELL GARDENS PH. 3

file name
19014-GP-STD_DETAILS_A1
AI dang - Tue - Apr 14 2020 - 4:38 PM

project no.
19014

4

2012 CODE COMPLIANCE PACKAGE A1

All drawings specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.

These drawings and/or specifications have been reviewed by
 gkr 04/09/21
 FOR CHIEF BUILDING OFFICIAL DATE




FOR STRUCTURE ONLY

2012 CODE
COMPLIANCE PACKAGE A1

[illegible]



All drawings, specifications, related documents and data are the copyright property of VAB DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VAB DESIGN's written permission.

REC'D BY _____ DATE _____
REF'D TO _____ DATE _____

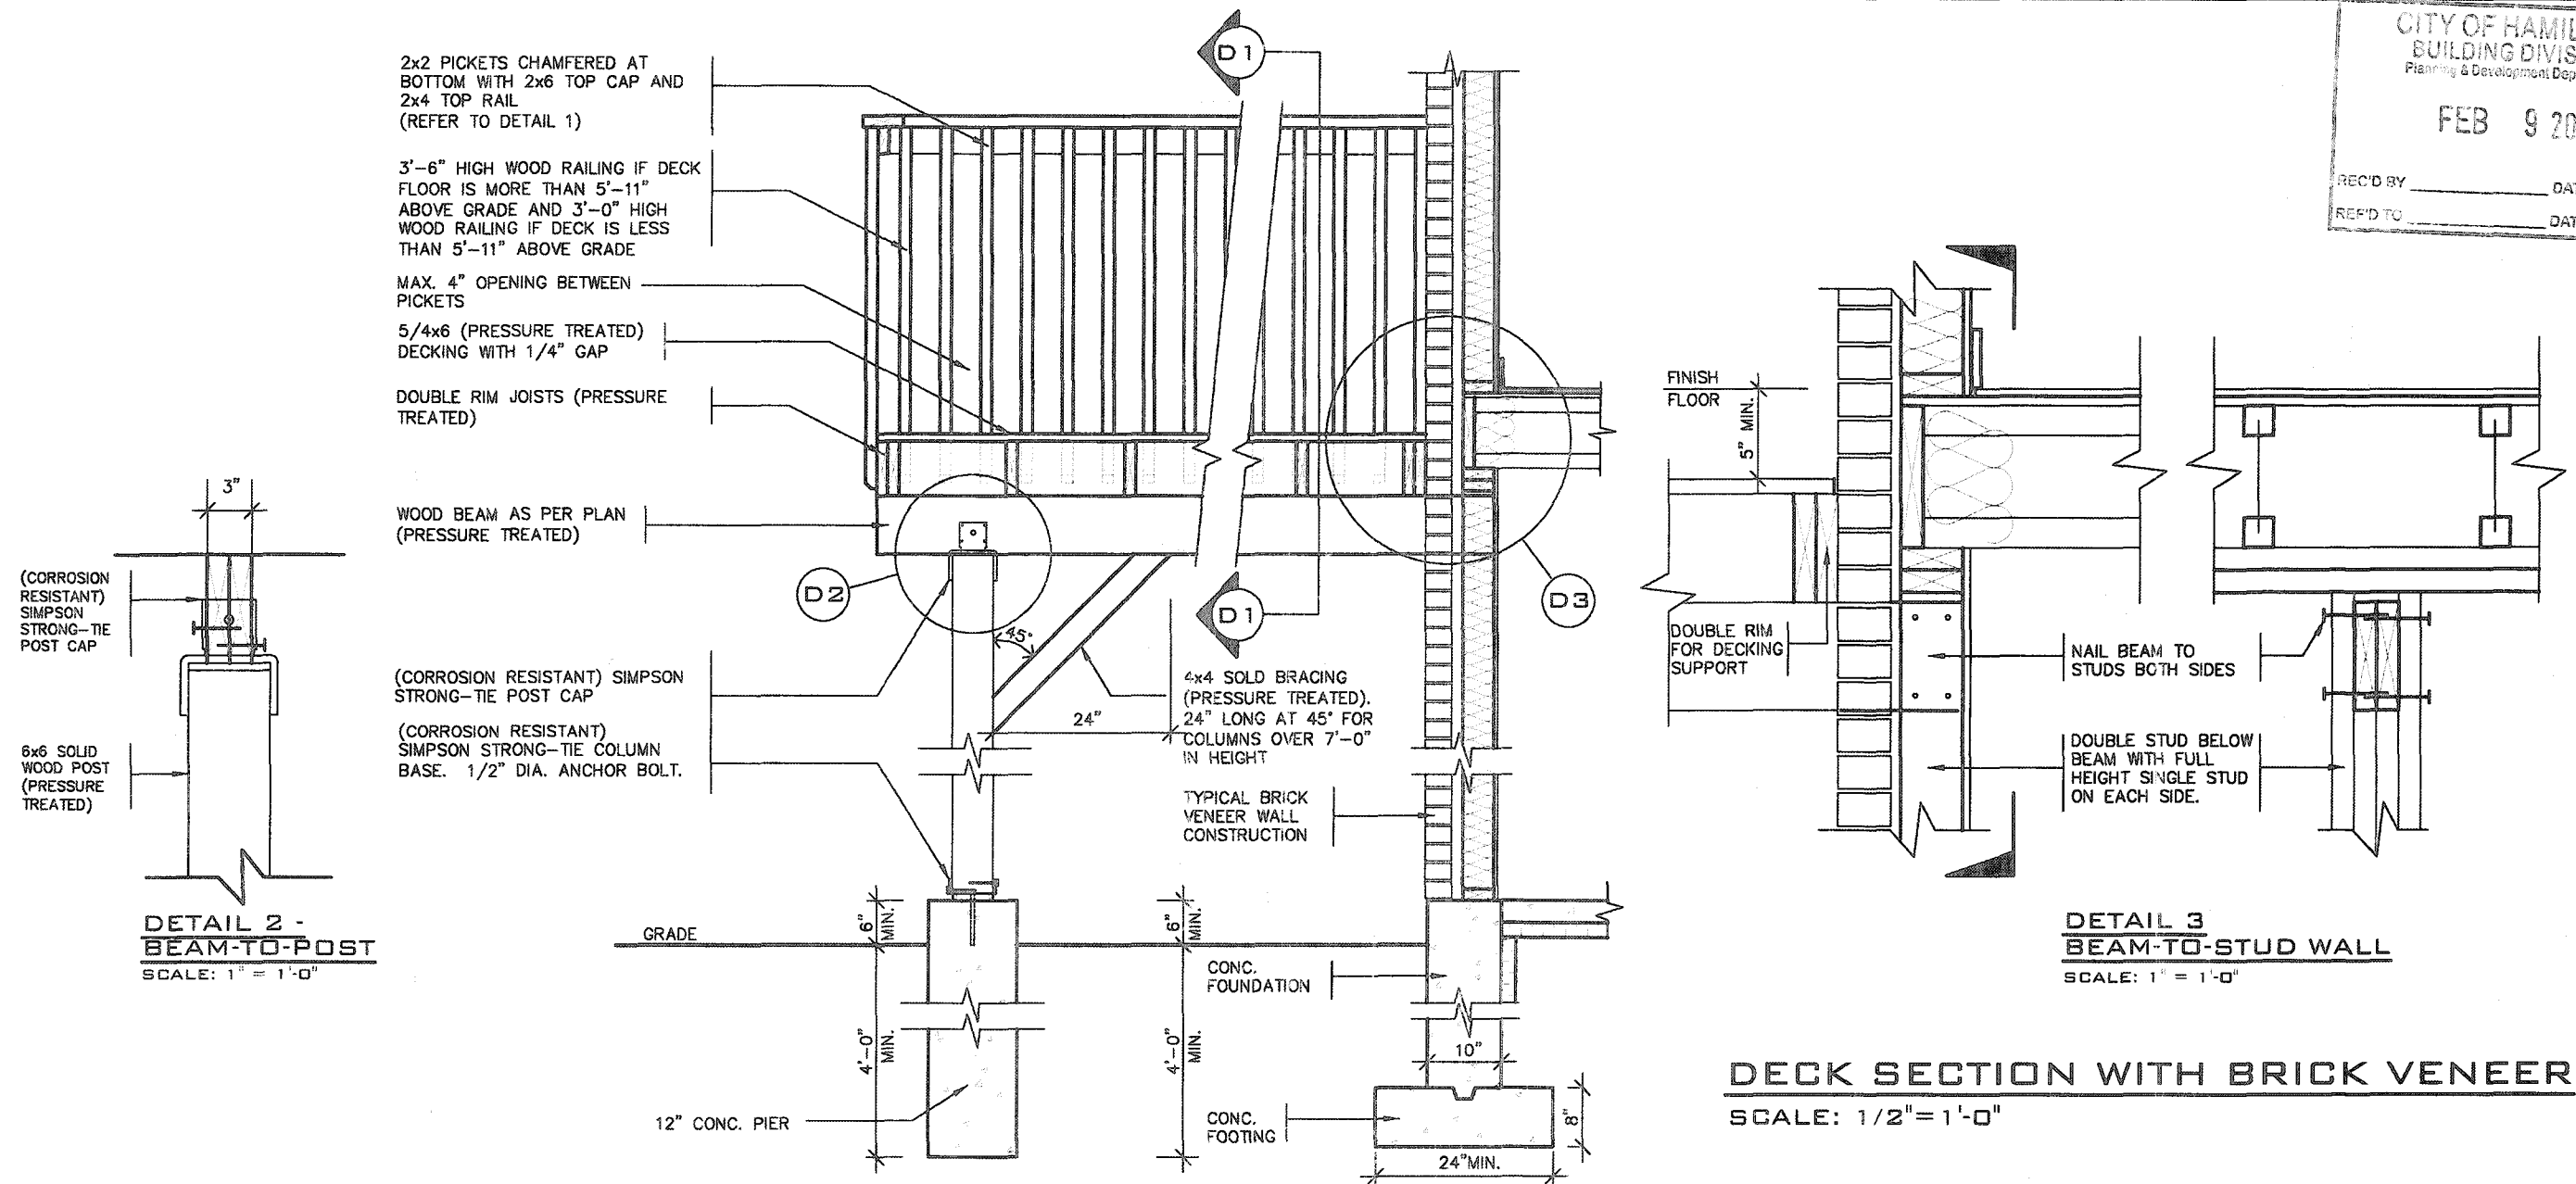

DECK SECTION WITH BRICK VENEER
SCALE: 1/2"=1'-0"

DETAIL 1
CANTILEVERED PICKET SCREWED TO RIM JOIST AND DECK
GUARD PARALLEL GUARD PERPENDICULAR
TO FLOOR JOISTS TO FLOOR JOISTS
 SCALE: 1" = 1'-0" SCALE: 1" = 1'-0"

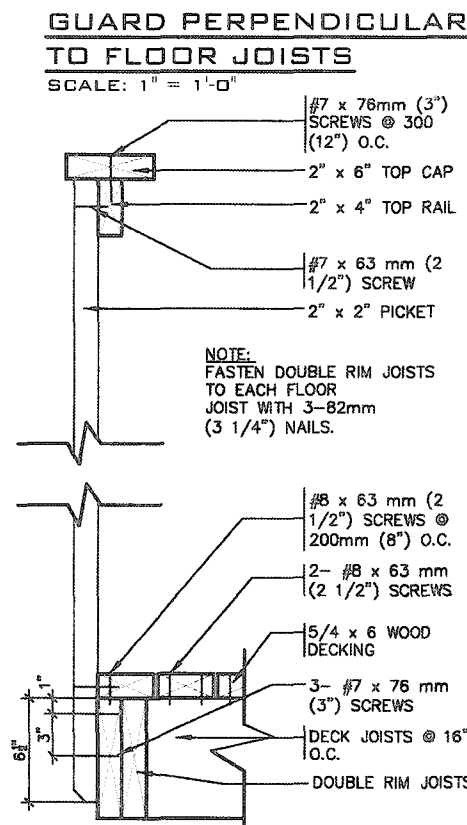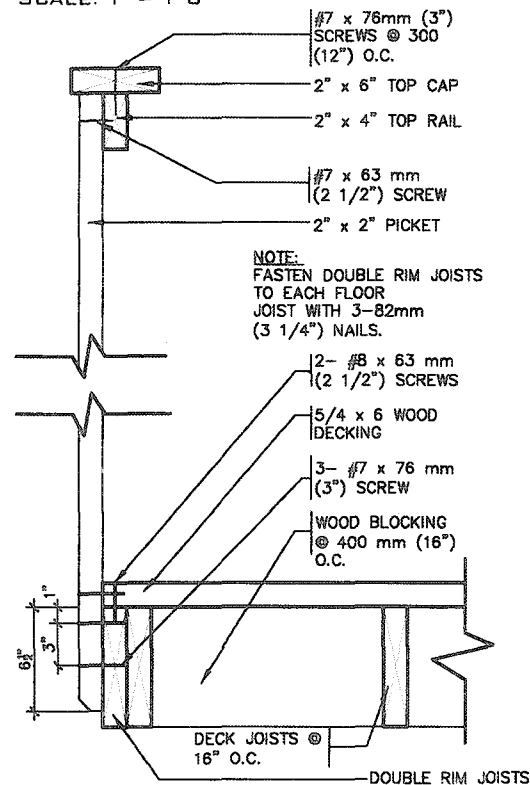

GENERAL NOTES

1. BRICK TO HAVE COMPRESSIVE STRENGTH OG 15mPa (2200 p.s.i) MIN.UNITS TO BE LAID WITH FULL HEAD AND BED JOINTS.
2. MORTAR TO BE TYPE 'S' WITH JOINT THICKNESS OF 10mm (3/8") MIN. AND 20mm (3/4") MAX.
3. THE DECK HAS BEEN DESIGNED TO SAFELY SUPPORT A SUPERIMPOSED LOAD OF 1.9kPa. [40psf].
4. ALL NAILS AND SCREWS TO BE GALVANIZED.
5. WOOD FOR CANTILEVERED PICKETS SHALL BE DOUGLAS FIR--LARCH, SPRUCE--PINE--FIR, OR HEM--FIR SPECIES.
6. CONCRETE SHALL HAVE COMPRESSIVE STRENGTH OF 20MPa. AT 28 DAYS AND 5-8% AIR ENTRAINED.
7. FOOTING TO BE PLACED ON UNDISTURBED SOIL WITH MINIMUM BEARING PRESSURE OF 150kPa [3130psf].
8. WB1= 2- 2"x8" (PRESSURE TREATED)
WB3= 2- 2"x10" (PRESSURE TREATED)

CITY OF HAMILTON
Building Division

Permit No. 21-107197

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

G.R. 04/09/21.

FOR CHIEF BUILDING OFFICIAL DATE

STRUDET INC.



FOR STRUCTURE ONLY

2012 CODE
COMPLIANCE PACKAGE A1


9						The undersigned has reviewed and takes responsibility for this design and how the qualifications and meets the requirements set out in the
8						Ontario Building Code to be a Designer.
7						qualification information
6						Richard Vink <i>R Vink</i> 244
5						name signature
4						registration information
3						VAS Design Inc. 428
2						Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the proper use of the Designer which must be returned at the completion of the project. Drawings are not to be copied.
1	ISSUED FOR PERMIT.	APR 13/20	GW			
no.	description	date	by			

**V3
DESIGN**
255 Consumers Rd Suite 12
Toronto ON M2J 1R4
t 416.630.2255 f 416.630.47
va3design.com




SINGLES


project name RUSSELL GARDENS PH. 3	municipality WATERDOWN	project no. 19014
date APRIL 2020		drawing no. 6
WOOD DECK DETAILS-WALK-OUT CONDITION		
drawn by GW	checked by -	scale As Shown
file name 19014-GP-STD_DETAILS_A1		

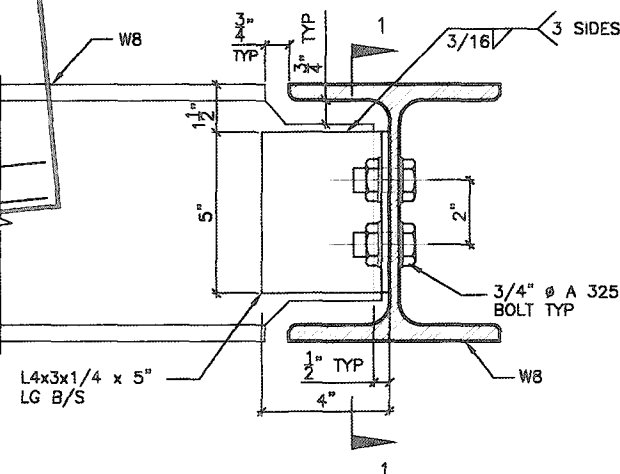


W8
TO
W8
CONNECTION

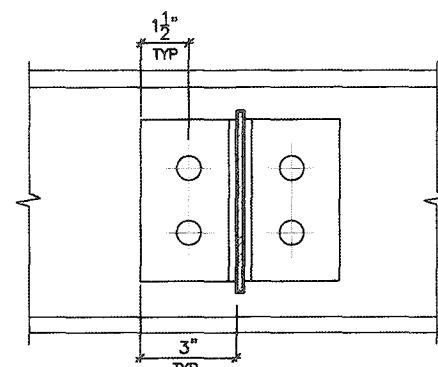


SECTION 1-1

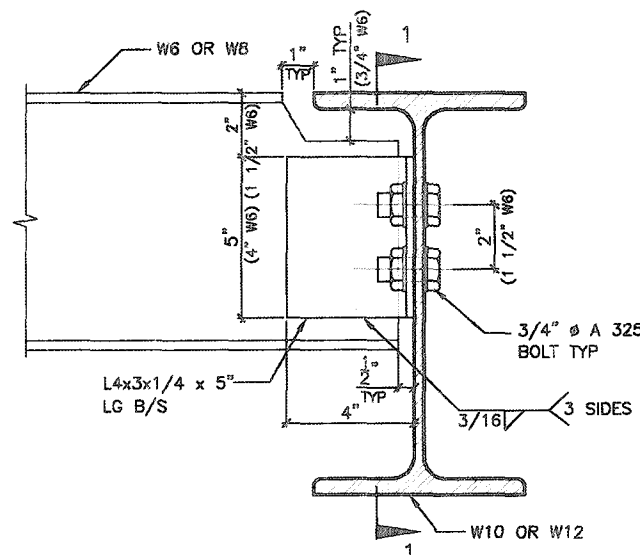


W6(W8)
TO
W10(W12)
CONNECTION

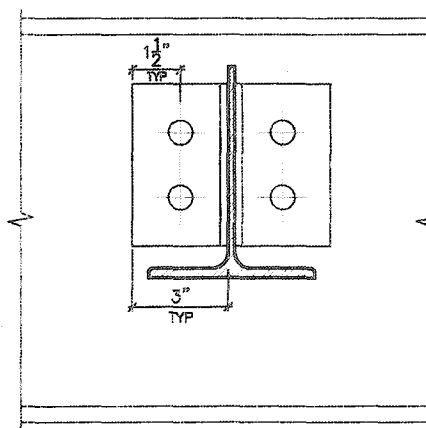


SECTION 1-1

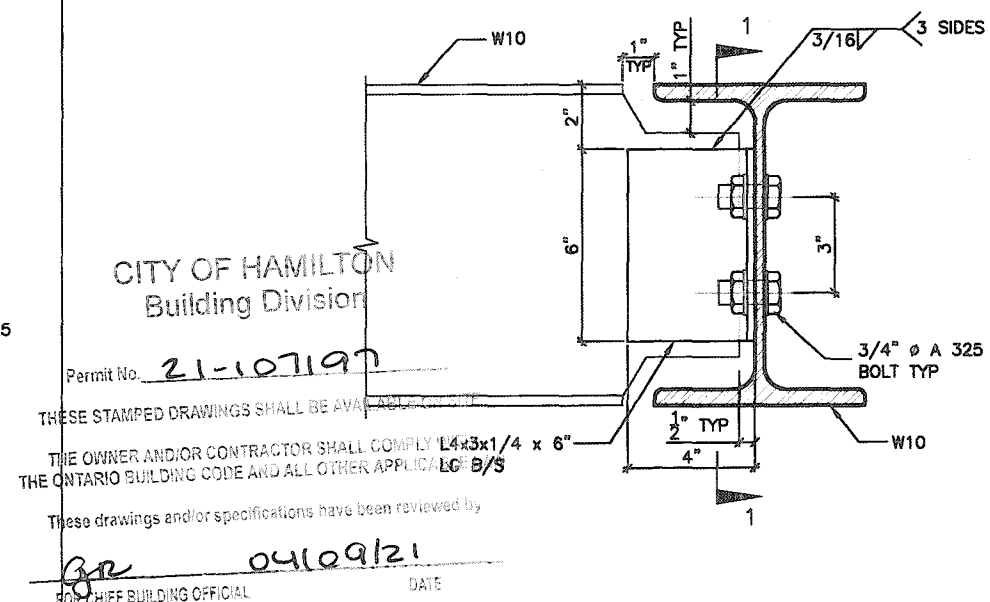


W10
TO
W10
CONNECTION

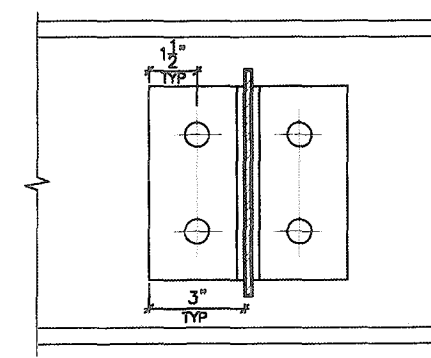


SECTION 1-1

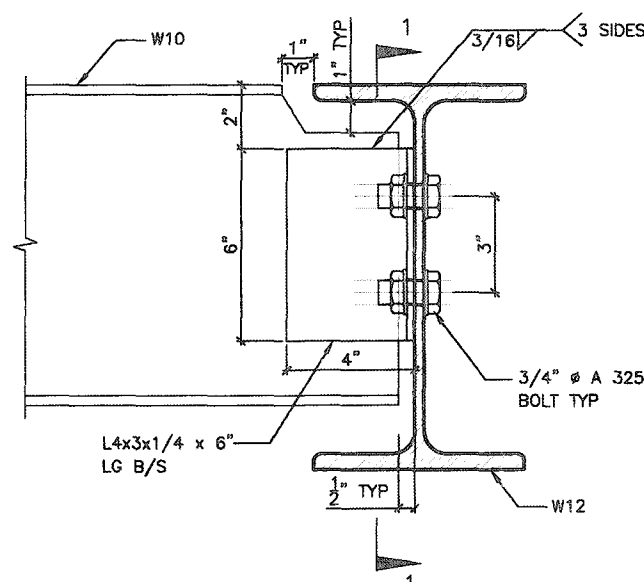


W10
TO
W12
CONNECTION

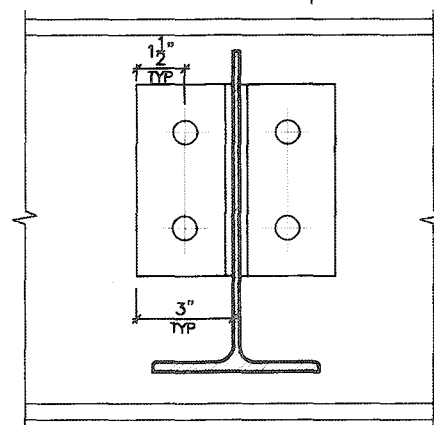


SECTION 1-1

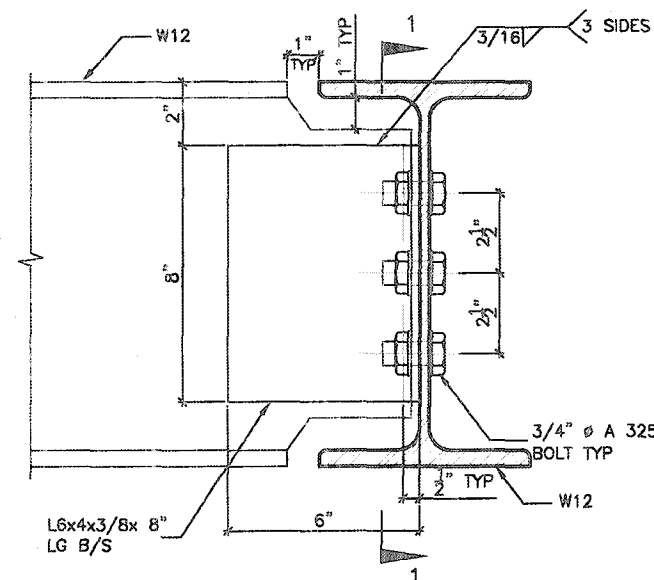


W12
TO
W12
CONNECTION

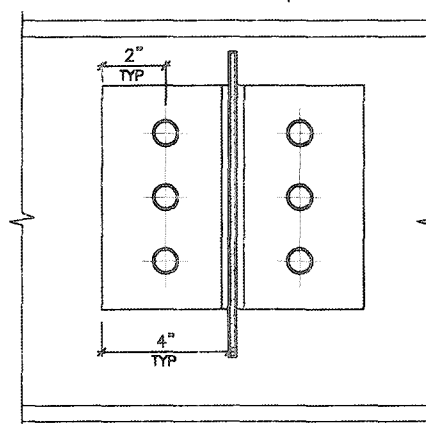

SECTION 1-1

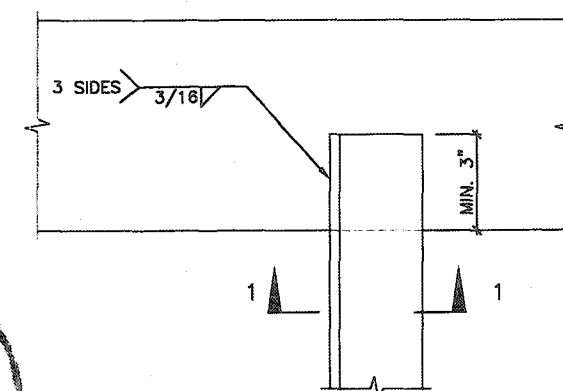


PLAN VIEW

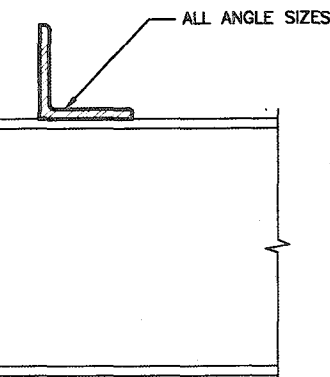

ALL BEAM SIZES — SECTION 1-1


2012 CODE E PACKAGE

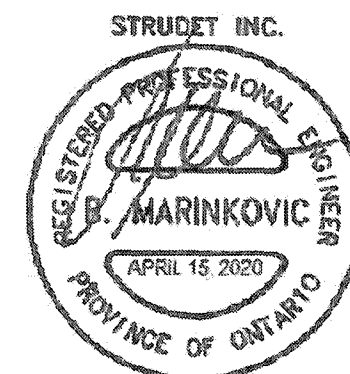

FOR STRUCTURE ONLY

ANGLE
TO
BEAM
CONNECTION

9						The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the
8						Ontario Building Code to be a Designer.
7						qualification information
6						Richard Vink 2448
5						name signature
4						registration information
3						VAS Design Inc. 4255
2						
1	ISSUED FOR PERMIT.	APR 13/20	GW			Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.
no.	description	date	by			



SINGLES

project name	city	municipality	project no.
RUSSELL GARDENS PH. 3	WATERDOWN		19014
date	steel beam connections		drawing no.
APRIL 2020			
drawn by	checked by	scale	file name
GW	-	Not to Scale	19014-GP-STD_DETAILS_A1

RESISTANCE TO FORCED ENTRY (OBC 9.6.8.)

BATH TUB/ SHOWER FRONT ELEVATION

BATH TUB SHOWER

TOILET SIDE ELEVATION

STRUCTURAL REINFORCEMENT FOR GRAB BAR (OBC 9.5.2.3.)

FOR MAIN BATH ONLY

MAY VARY
 CITY OF HAMILTON
 HEADSIDE ELEVATION
 Planning & Development Department
 FEB 9 2021
 REC'D BY _____ DATE _____
 REC'D TO _____ DATE _____

CITY OF HAMILTON
Building Division


Permit No. 21107L97

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by _____

FOR CHIEF BUILDING OFFICIAL DATE 04/09/21

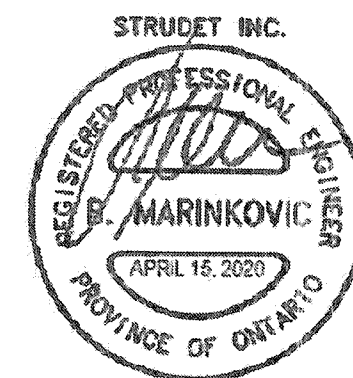

FOR STRUCTURE ONLY

STRUCTURE ONLY

2012 CODE
COMPLIANCE PACKAGE

9		-	-	The undersigned has reviewed and taken responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.	
8		-	-	qualification information	
7		-	-	Richard Vink	2448
6		-	-	 signature	BOL
5		-	-	registration information	
4		-	-	VAS Design Inc.	4265
3		-	-		
2		-	-		
1	ISSUED FOR PERMIT.	APR 13/20	CW	Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be copied.	
no.	description	date by			



255 Consumers Rd Suite 120
Toronto ON M2J 1R4
t 416.630.2255 f 416.630.478
va3design.com



project name	manhole	project no.
RUSSELL GARDENS PH. 3	WATERDOWN	19014
date	STUD WALL REINFORCEMENT	drawing no.
APRIL 2020		
drawn by	checked by	scale
GW	-	Not to Scale
		19014-GP-STD_DETAILS_A1
		8

CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department

FEB 9 2021

REC'D BY _____ DATE _____
REP'D TO _____ DATE _____

TYPICAL ROOF
CONSTRUCTION

VENTED SOFFIT
TRIM
AIR SPACE

STUCCATO/ HARDI
BOARD/CREZON
FINISH

GAP IN NAILERS
1" x 3" WOOD NAILERS
#15 BUILDING PAPER
7/16" OSB SHEATHING

1/2" DRYWALL FINISH
6 MIL POLY VAPOUR
BARRIER
R22 BATT. INSULATION
BETWEEN STUDS

PREFIN. METAL
FLASHING
ROOF SHEATHING
ON ROOF RAFTERS

STEEL
STRUCTURE

BRICK BEYOND
CROSS SECTION


CITY OF HAMILTON
Building Division

Permit No. 21-107197

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW


These drawings and/or specifications have been reviewed by

GJR 04/09/21
FOR CHIEF BUILDING OFFICIAL DATE

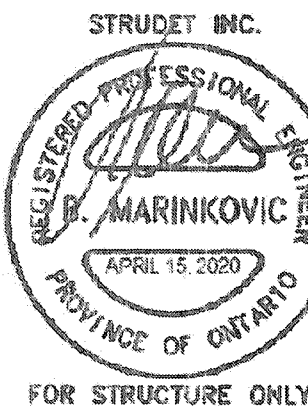

FOR STRUCTURE ONLY

2012 CODE
COMPLIANCE PACKAGE A1

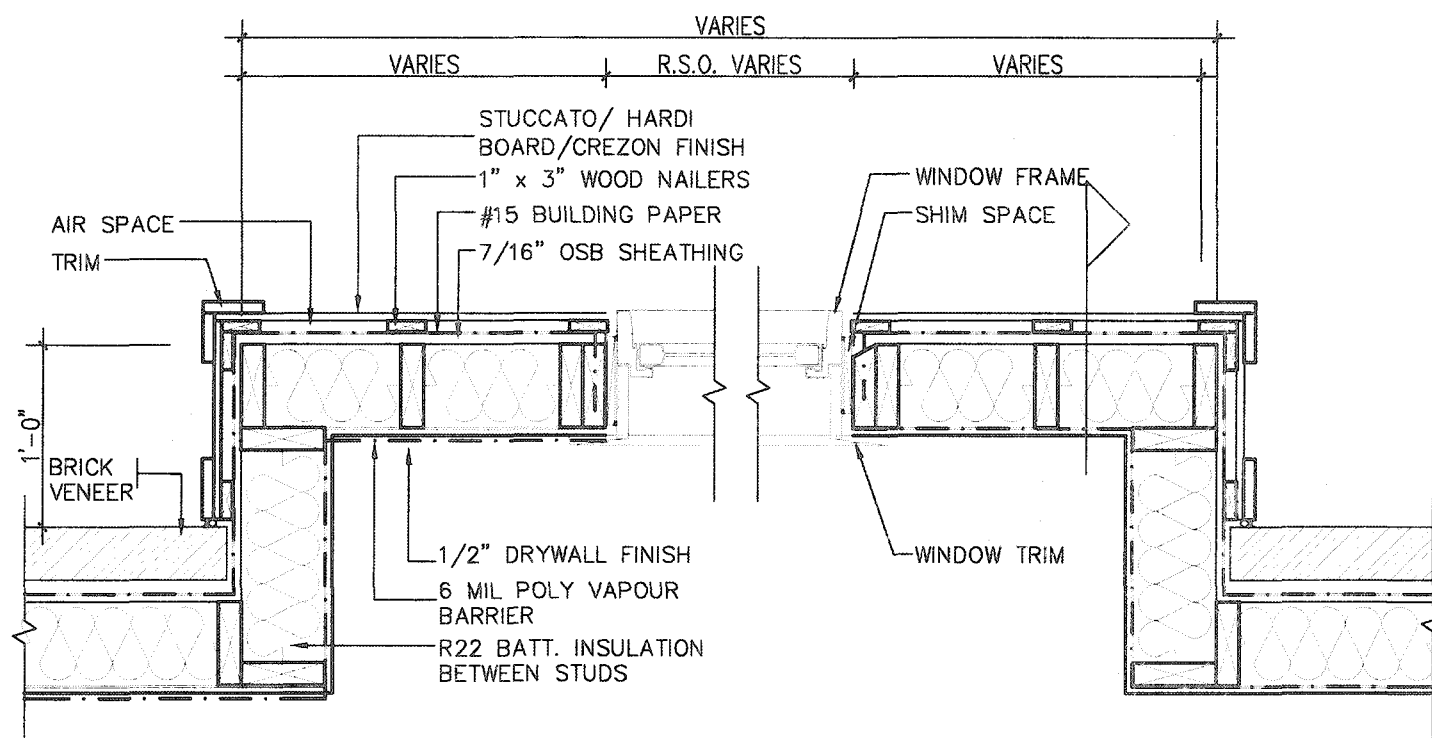

PLAN VIEW

STUCCATO BOARD FINISH CLADDING OR EQUAL (OBC 9.27.)

9					
8					
7					
6					
5					
4					
3					
2					
1	ISSUED FOR PERMIT.	APR 13/20	GW		
no.	description	date	by		

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.

qualification information
Richard Vink 24488
signature
name
registration information
VA3 Design Inc. 42658

Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.

**VA3
DESIGN**

255 Consumers Rd Suite 120
Toronto ON M2J 1R4
t 416.630.2255 f 416.630.4782
va3design.com

Greenpark

project name
RUSSELL GARDENS PH. 3

location
WATERDOWN

date
APRIL 2020

drawn by
GW

checked by
Not to Scale




scale
19014-GP-STD_DETAILS_A1

SINGLES


project no.
19014

drawing no.

9

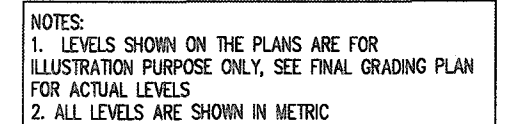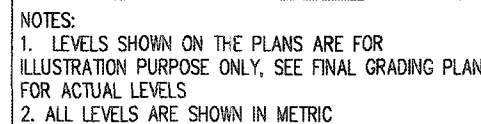

FOR CHIEF BUILDING OFFICIAL DATE

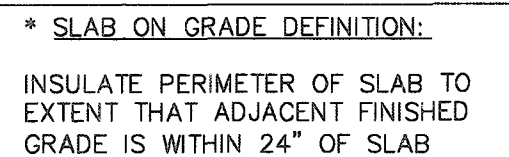

WALK OUT BASEMENT 2012 CODE COMPLIANCE PACKAGE

9		-	The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in Ontario Building Code to be a Designer.	
8		-	qualification information	
7		-	Richard Vink	244
6		-		signature
5		-	name	
4		-	registration information	
3		-	VAS Design Inc.	426
2		-		
1	ISSUED FOR PERMIT.	APR 13/20	GW	
no.	description	date	by	

VA3
DESIGN
255 Consumers Rd Suite
Toronto ON M2J 1R
t 416.630.2255 f 416.63
va3design.com

Greenpark.

project name	RUSSELL GARDENS PH. 3		municipality	WATERDOWN
date	APRIL 2020			
drawn by	checked by	scale	file name	
GW	-	Not to Scale	19014-GP-STD_DETAILS_A1	

SINGLES

project no.
9014

Order No.

10

All drawings, specifications, related documents and design are the copyright property of V43 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without V43 DESIGN's written permission.



NOTE: FOR MORE THAN 8 RISERS

CITY OF HAMILTON
Building Division

Permit No. 21-107197

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE
THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW
These drawings and/or specifications shall be used in accordance with the Ontario Building Code and all other applicable laws.



FOR CHIEF BUILDING OFFICIAL 04/09/21 DATE

FOR STRUCTURE ONLY

2012 CODE COMPLIANCE PACKAGE A1

[illegible]

All drawings, specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.

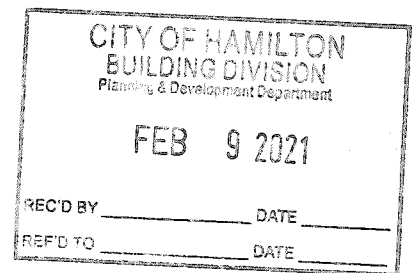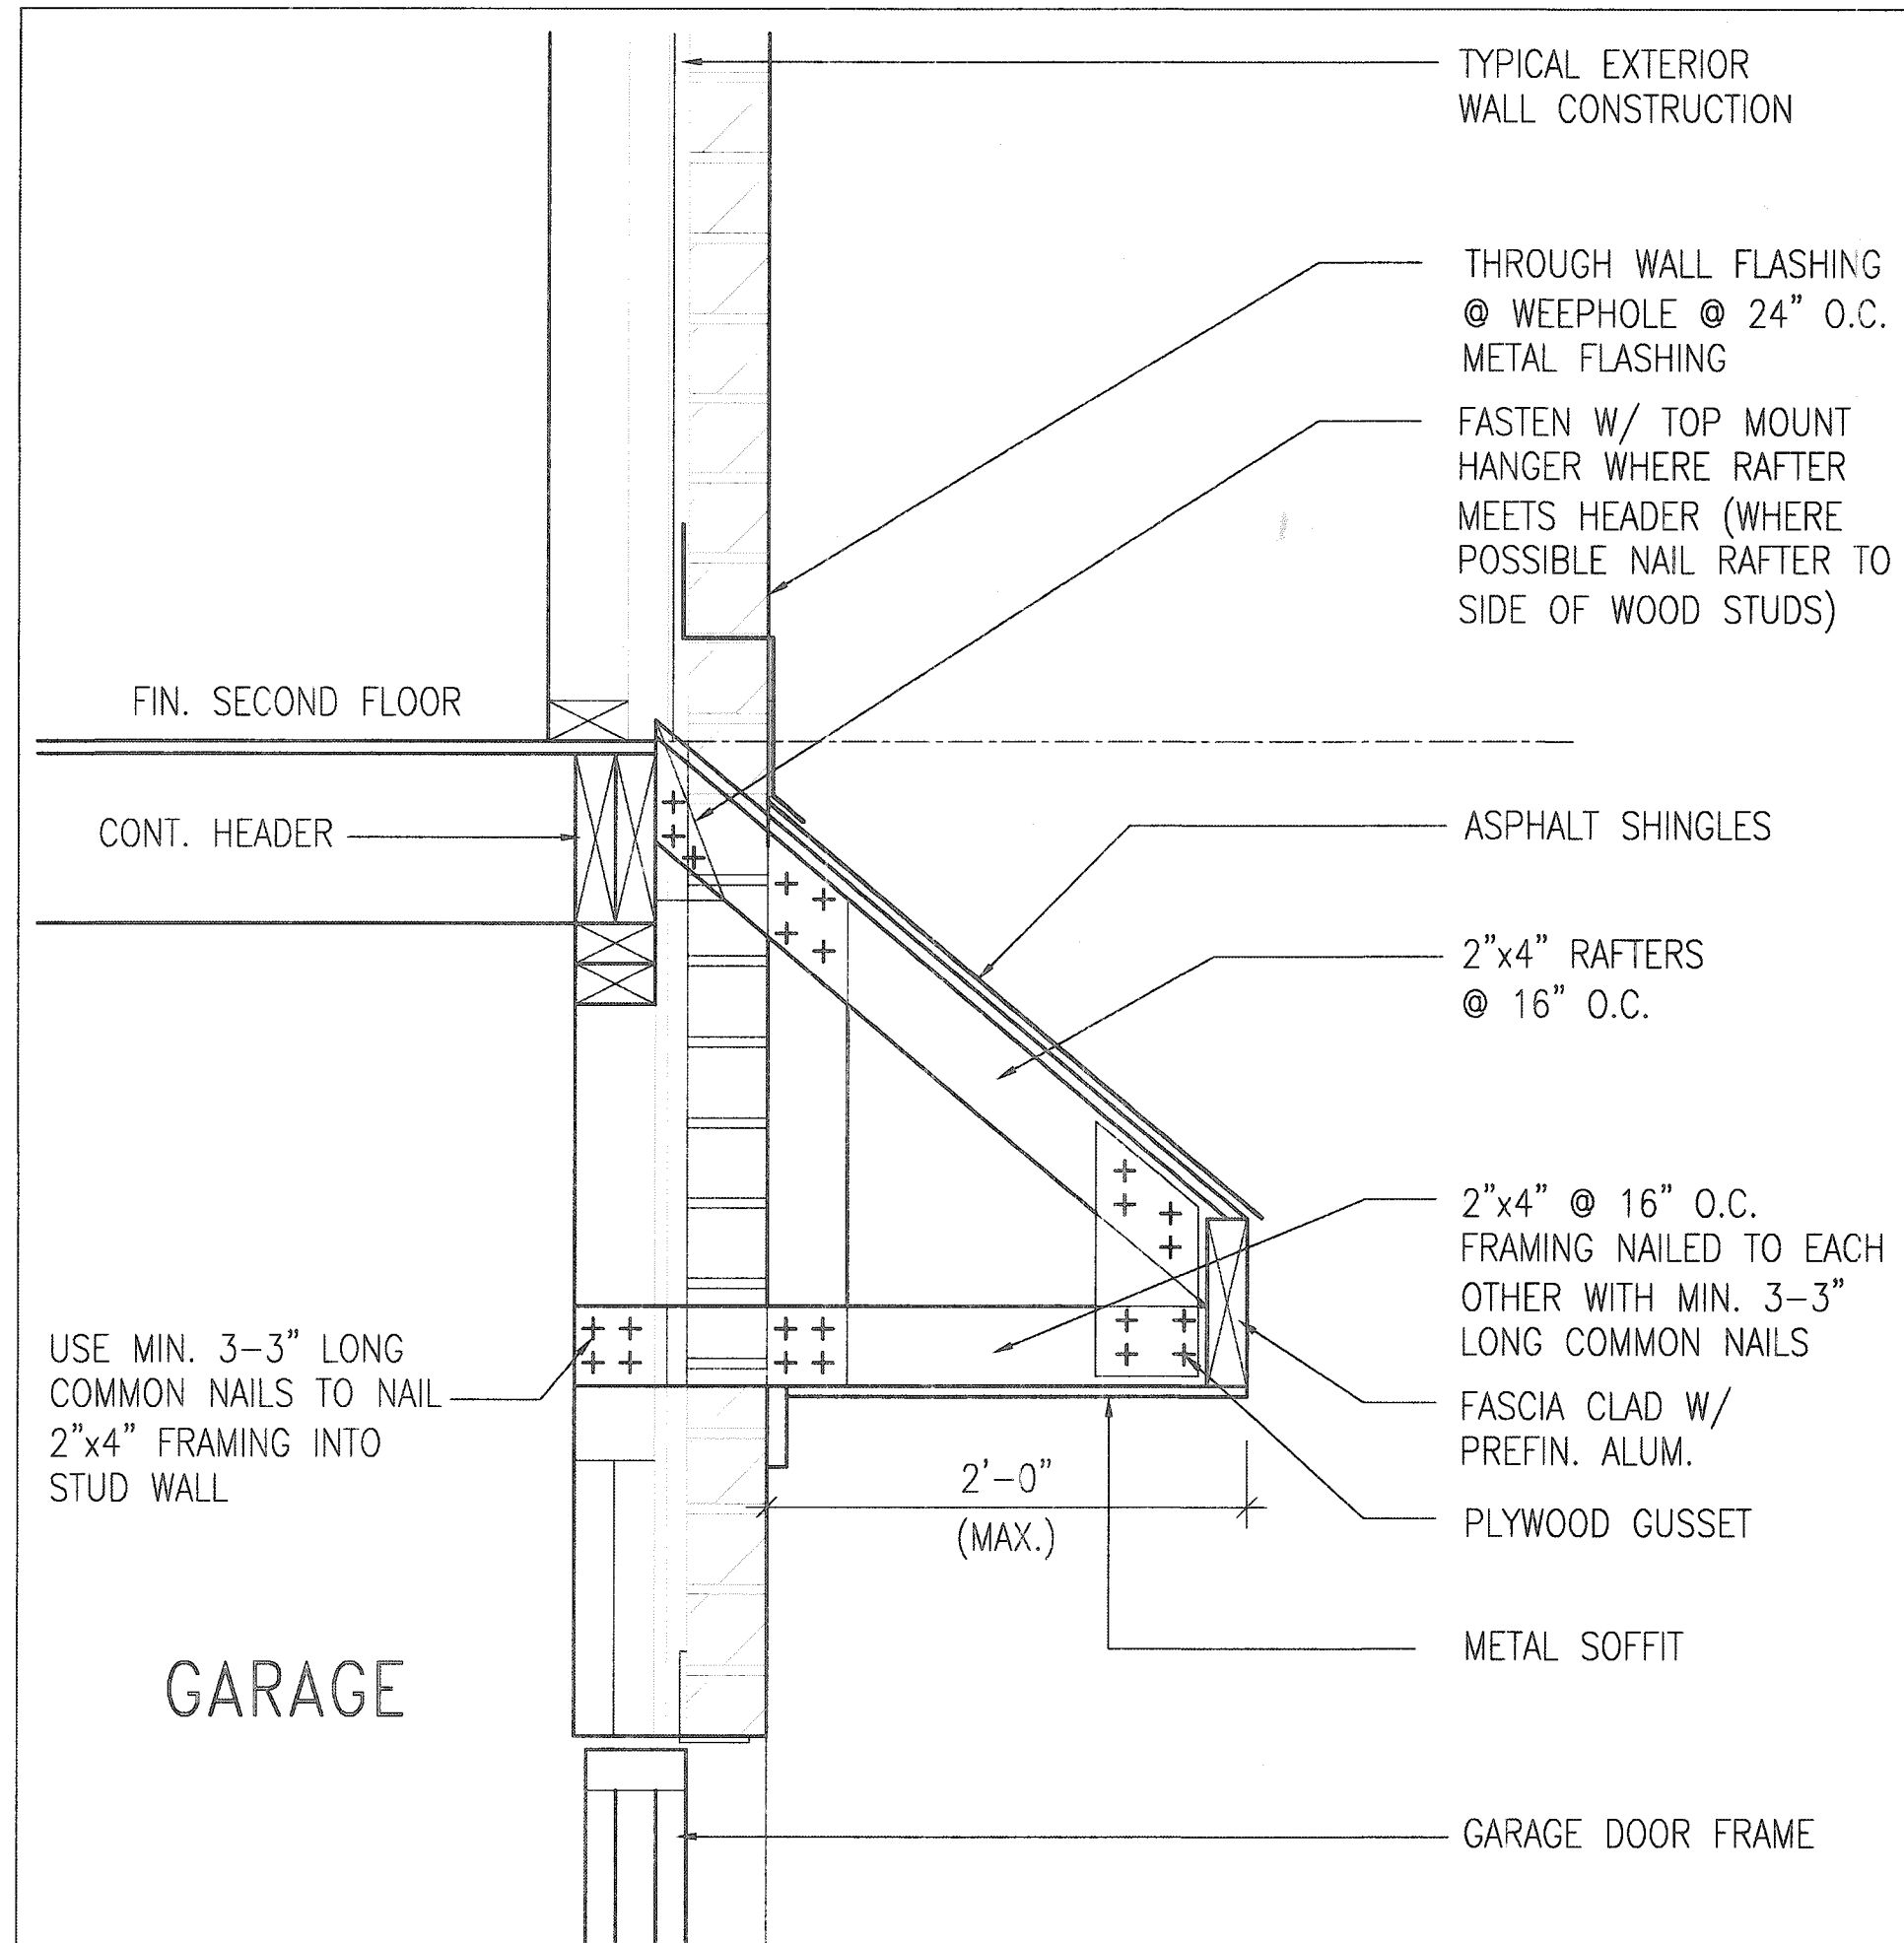

CITY OF HAMILTON
Building Division

Permit No. 21-107197

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by
GR 04/09/21
FOR CHIEF BUILDING OFFICIAL DATE



B ROOF OVERHANG DETAIL OVER GARAGE

**2012 CODE
COMPLIANCE PACKAGE A1**


9. The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. 7. qualification information 6. Richard Vink 24488 BDN 5. name signature 4. registration information VAS Design Inc. 42658 3. 2. 1. ISSUED FOR PERMIT. APR 13/20 GW no. description date by	The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. 7. qualification information 6. Richard Vink 24488 BDN 5. name signature 4. registration information VAS Design Inc. 42658 3. 2. 1. ISSUED FOR PERMIT. APR 13/20 GW no. description date by	VA3 DESIGN 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 va3design.com	Greenpark project name RUSSELL GARDENS PH. 3 municipality WATERDOWN date APRIL 2020 drawn by GW checked by Not to Scale 19014-GP-STD-DETAILS_A1	SINGLES project no. 19014 drawing no. 12
--	---	---	--	--



CITY OF HAMILTON
BUILDING DIVISION
Planning & Development Department

FEB 9 2021

REC'D BY _____ DATE _____
REF'D TO _____ DATE _____

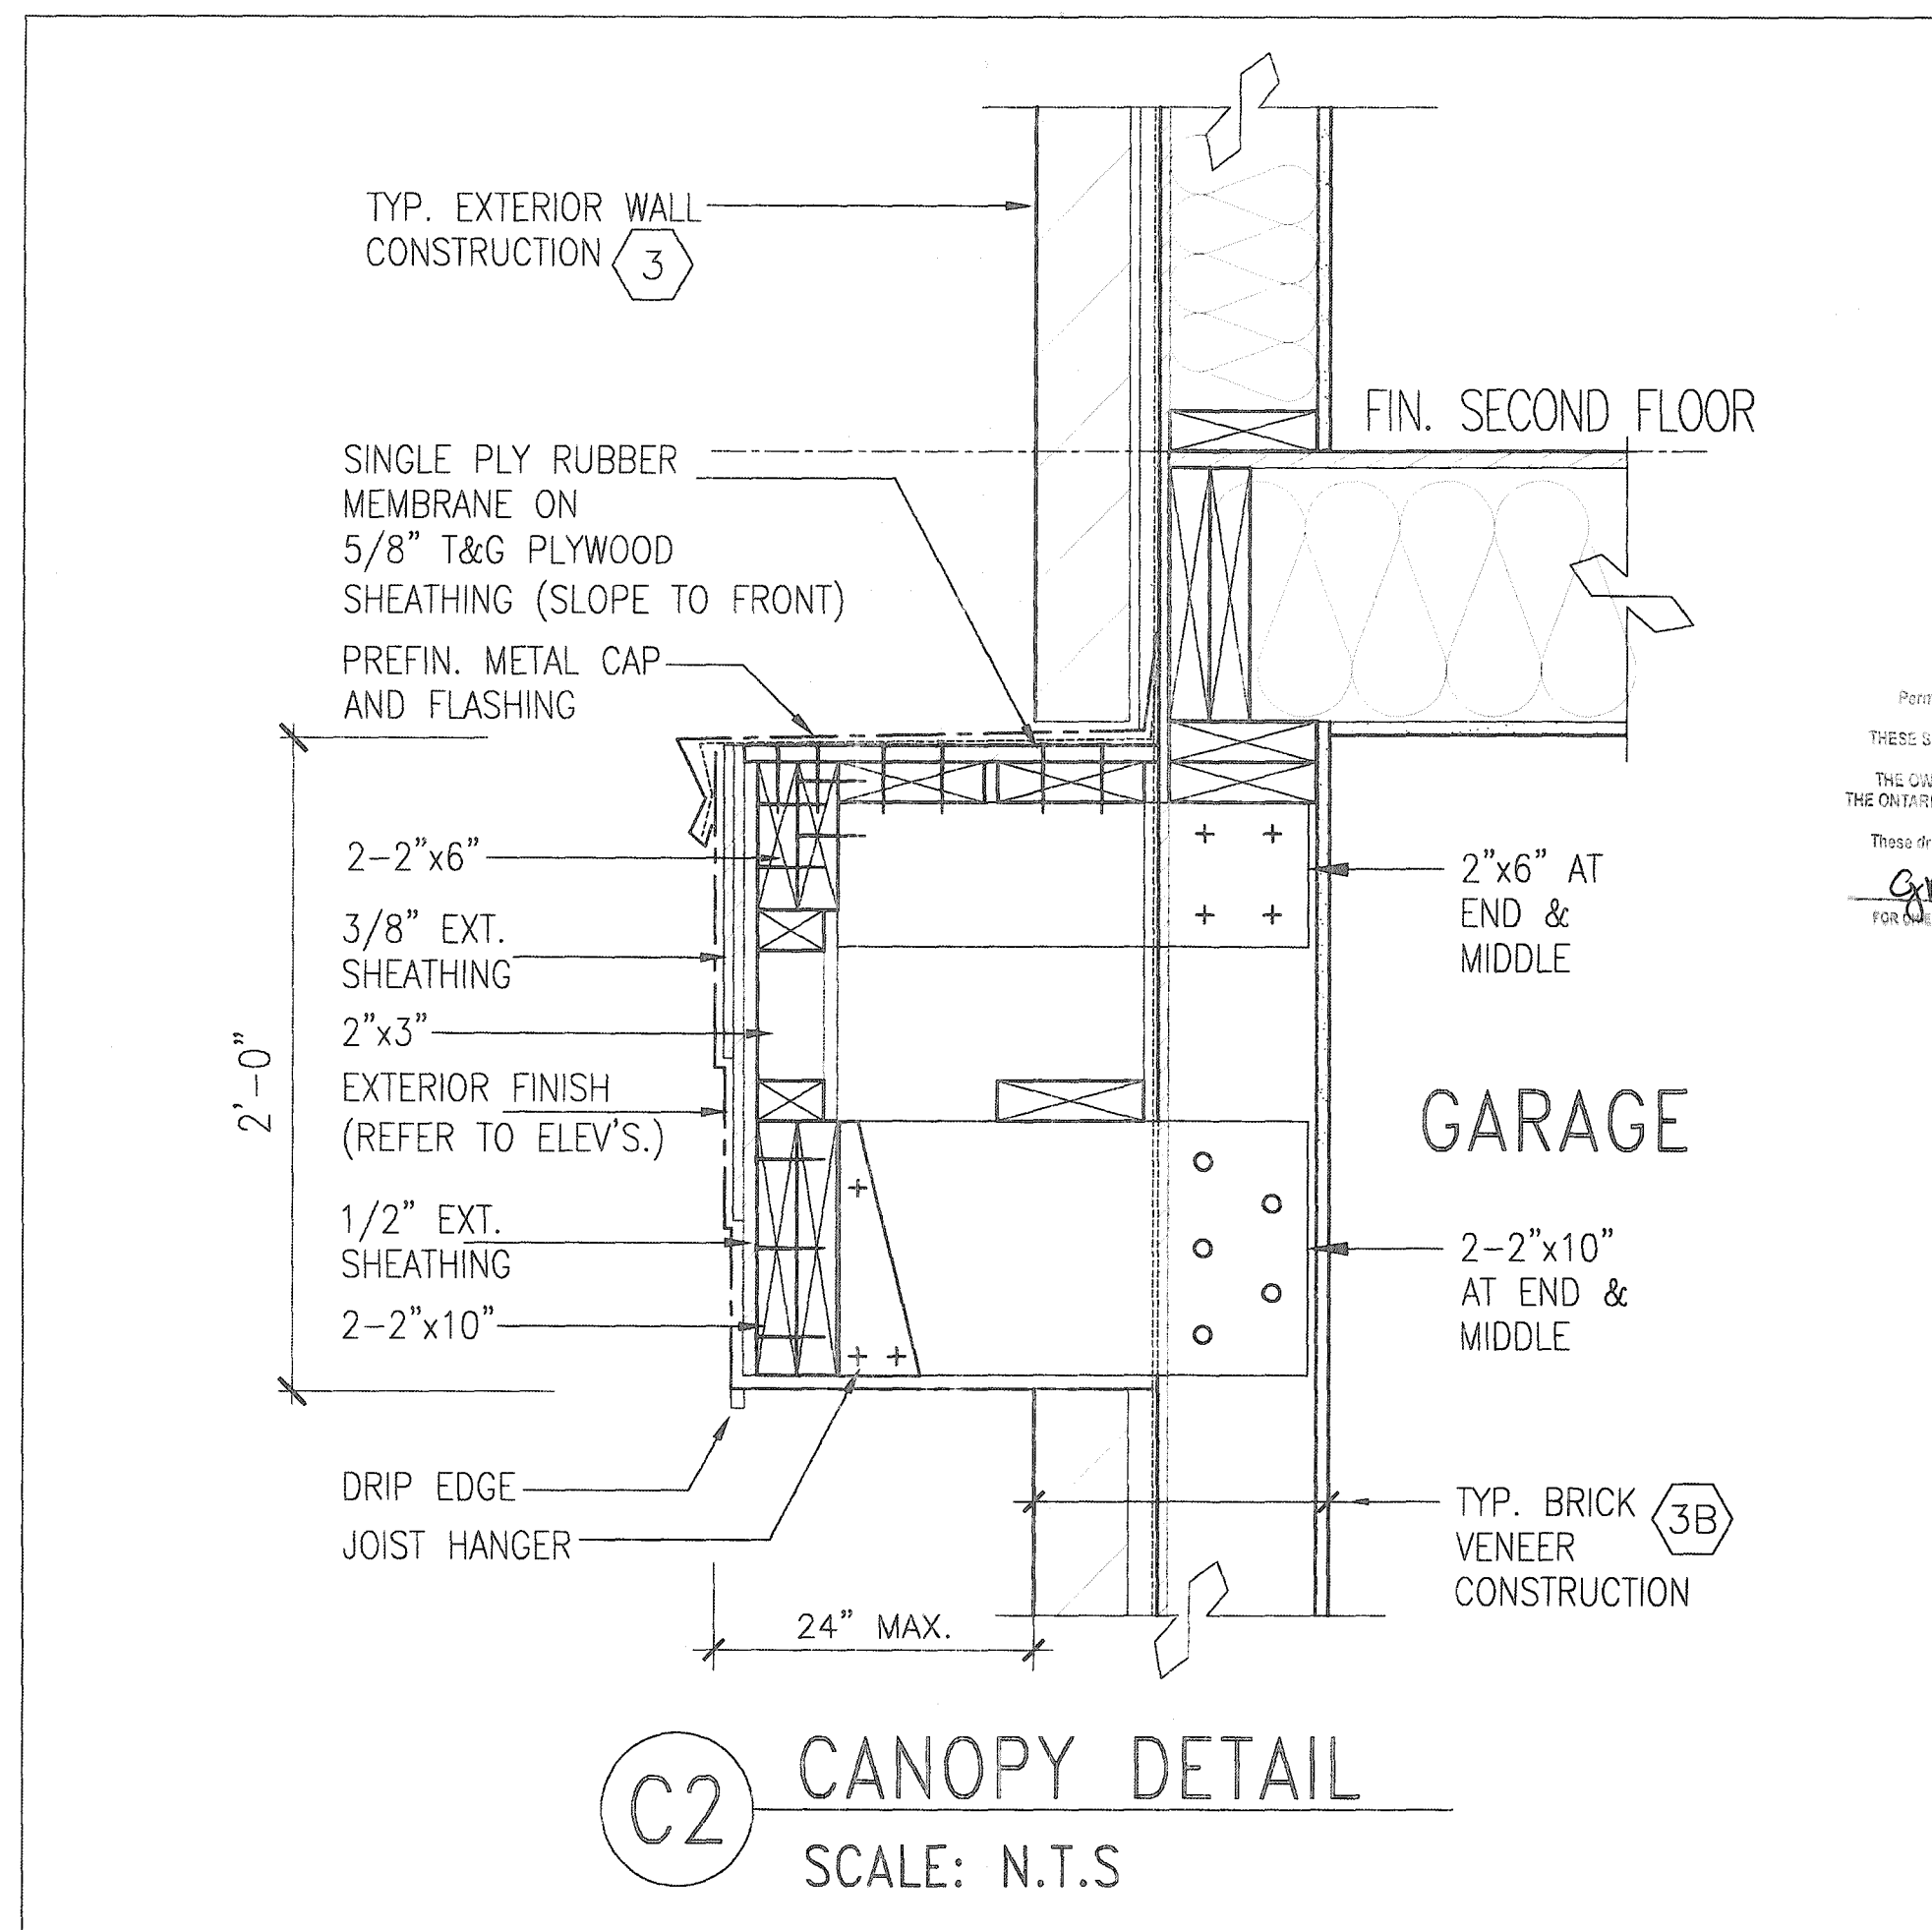

CITY OF HAMILTON
Building Division


Permit No. 21-107197

THESE STAMPED DRAWINGS SHALL BE AVAILABLE ON SITE

THE OWNER AND/OR CONTRACTOR SHALL COMPLY WITH
THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE LAW

These drawings and/or specifications have been reviewed by

GR 04/09/21
FOR OWNER BUILDING OFFICIAL DATE

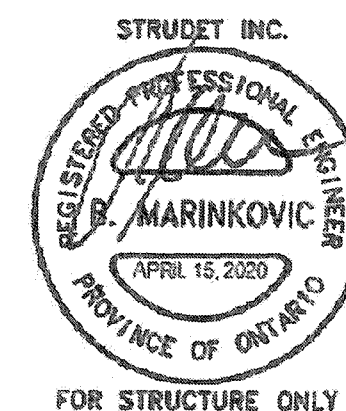

C2 CANOPY DETAIL
SCALE: N.T.S

2012 CODE
COMPLIANCE PACKAGE A1

9. The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. 10. qualification information 11. Richard Vink 24488 12. name signature 13. registration information 14. VAS Design Inc. 42658		Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.		VA3 DESIGN 255 Consumers Rd Suite 120 Toronto ON M2J 1R4 t 416.630.2255 f 416.630.4782 va3design.com		Greenpark project name <u>RUSSELL GARDENS PH. 3</u> municipality <u>WATERDOWN</u> project no. <u>19014</u> date <u>APRIL 2020</u> checked by <u>oash</u> CANOPY ROOF AT GARAGE DETAIL drawn by <u>GW</u> Not to Scale 19014-GP-STD_DETAILS_A1		SINGLES drawing no. 14	
--	--	--	--	---	--	--	--	--	--